


3–7 CONTROL LOGIC BOARD

PD1 A14 A2, A3, A4
CONTROL LOGIC BOARD

46–307819P12

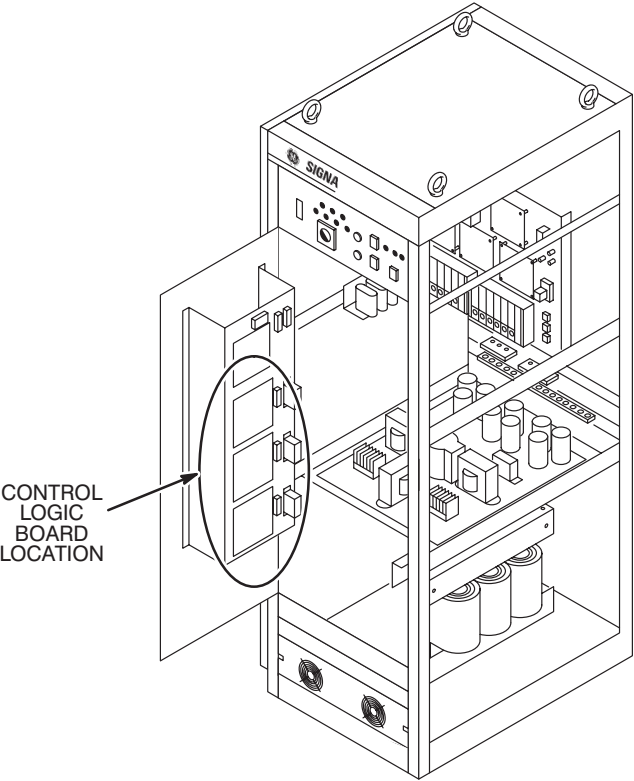

Description

The control logic board monitors each line current and compares each signal to a preset level in order to activate the regulation circuit and monitors each input line–to–line voltage to select the appropriate transformer tap. The output stage on the control logic board acts as an interface to the SCR driver board. The master reset circuit on the control logic board inhibits the output for 6 seconds and is activated by the Main Circuit Breaker or the undervoltage detection circuit. The undervoltage detection circuit compares the input voltage signal to a preset reference of 3V. When the voltage falls below the reference level, the SCR drive circuit is turned off. The undervoltage shutdown occurs when the line voltage sags by 40% for at least 2 cycles.

PD1 A14A2, A14A3, A14A4

REV. 0	46-307819P12
TITLE	CONT ON SHEET - SH NO. 1
CONTROL LOGIC BOARD	

