


State: RELEASE - Document is released and under formal Change Control. Changes are subject to the ECR/ECO Process. See the GEMS ePDM System to determine the status of this document.

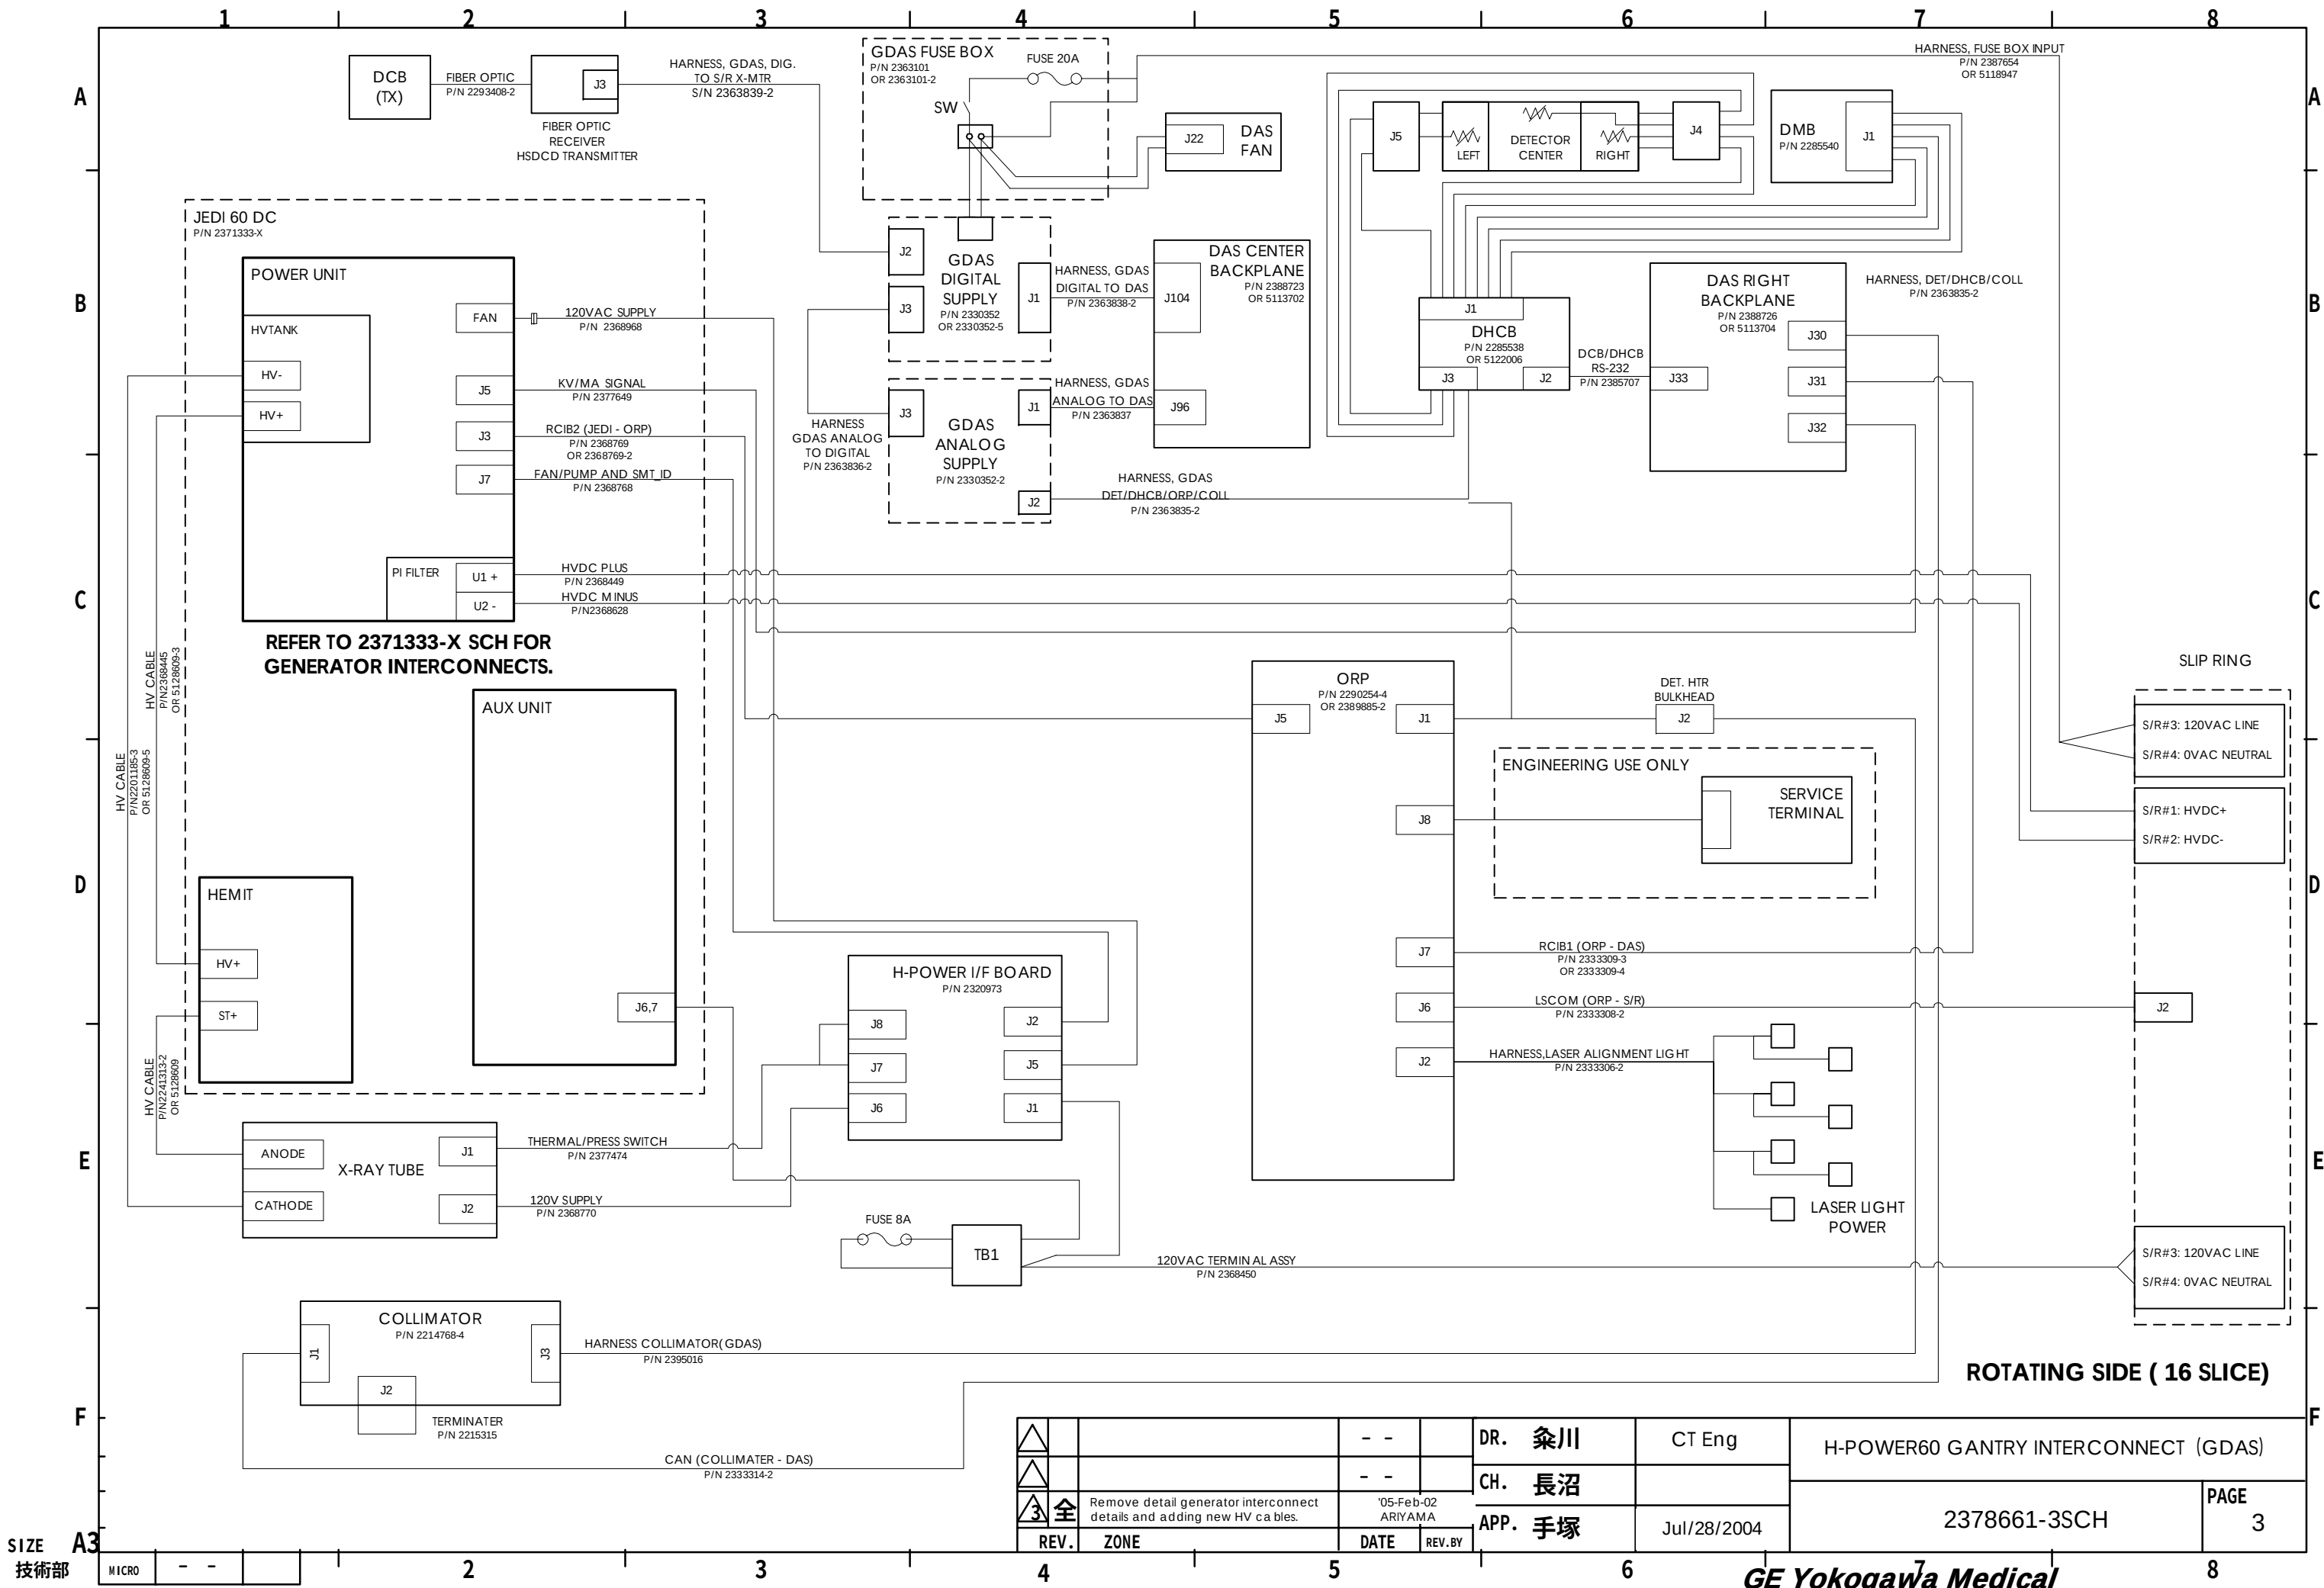

△		- -		DR. 桑川	CT Eng	H-POWER60 GANTRY INTERCONNECT (GDAS)	
△		- -		CH. 長沼			
3全	Remove detail generator interconnect details and adding new HV cables.	'05-Feb-02	ARIYAMA	APP. 手塚	Jul/28/2004	2378661-3SCH	PAGE 3
REV.	ZONE	DATE	REV. BY				