



TCT Run TD_E_TCT_polished_5 Summary

Parameter	Value
Run	TD_E_TCT_polished_5
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	150.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080426\150V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	8/4/2026
Gain Constant	N/A


Collected Charge

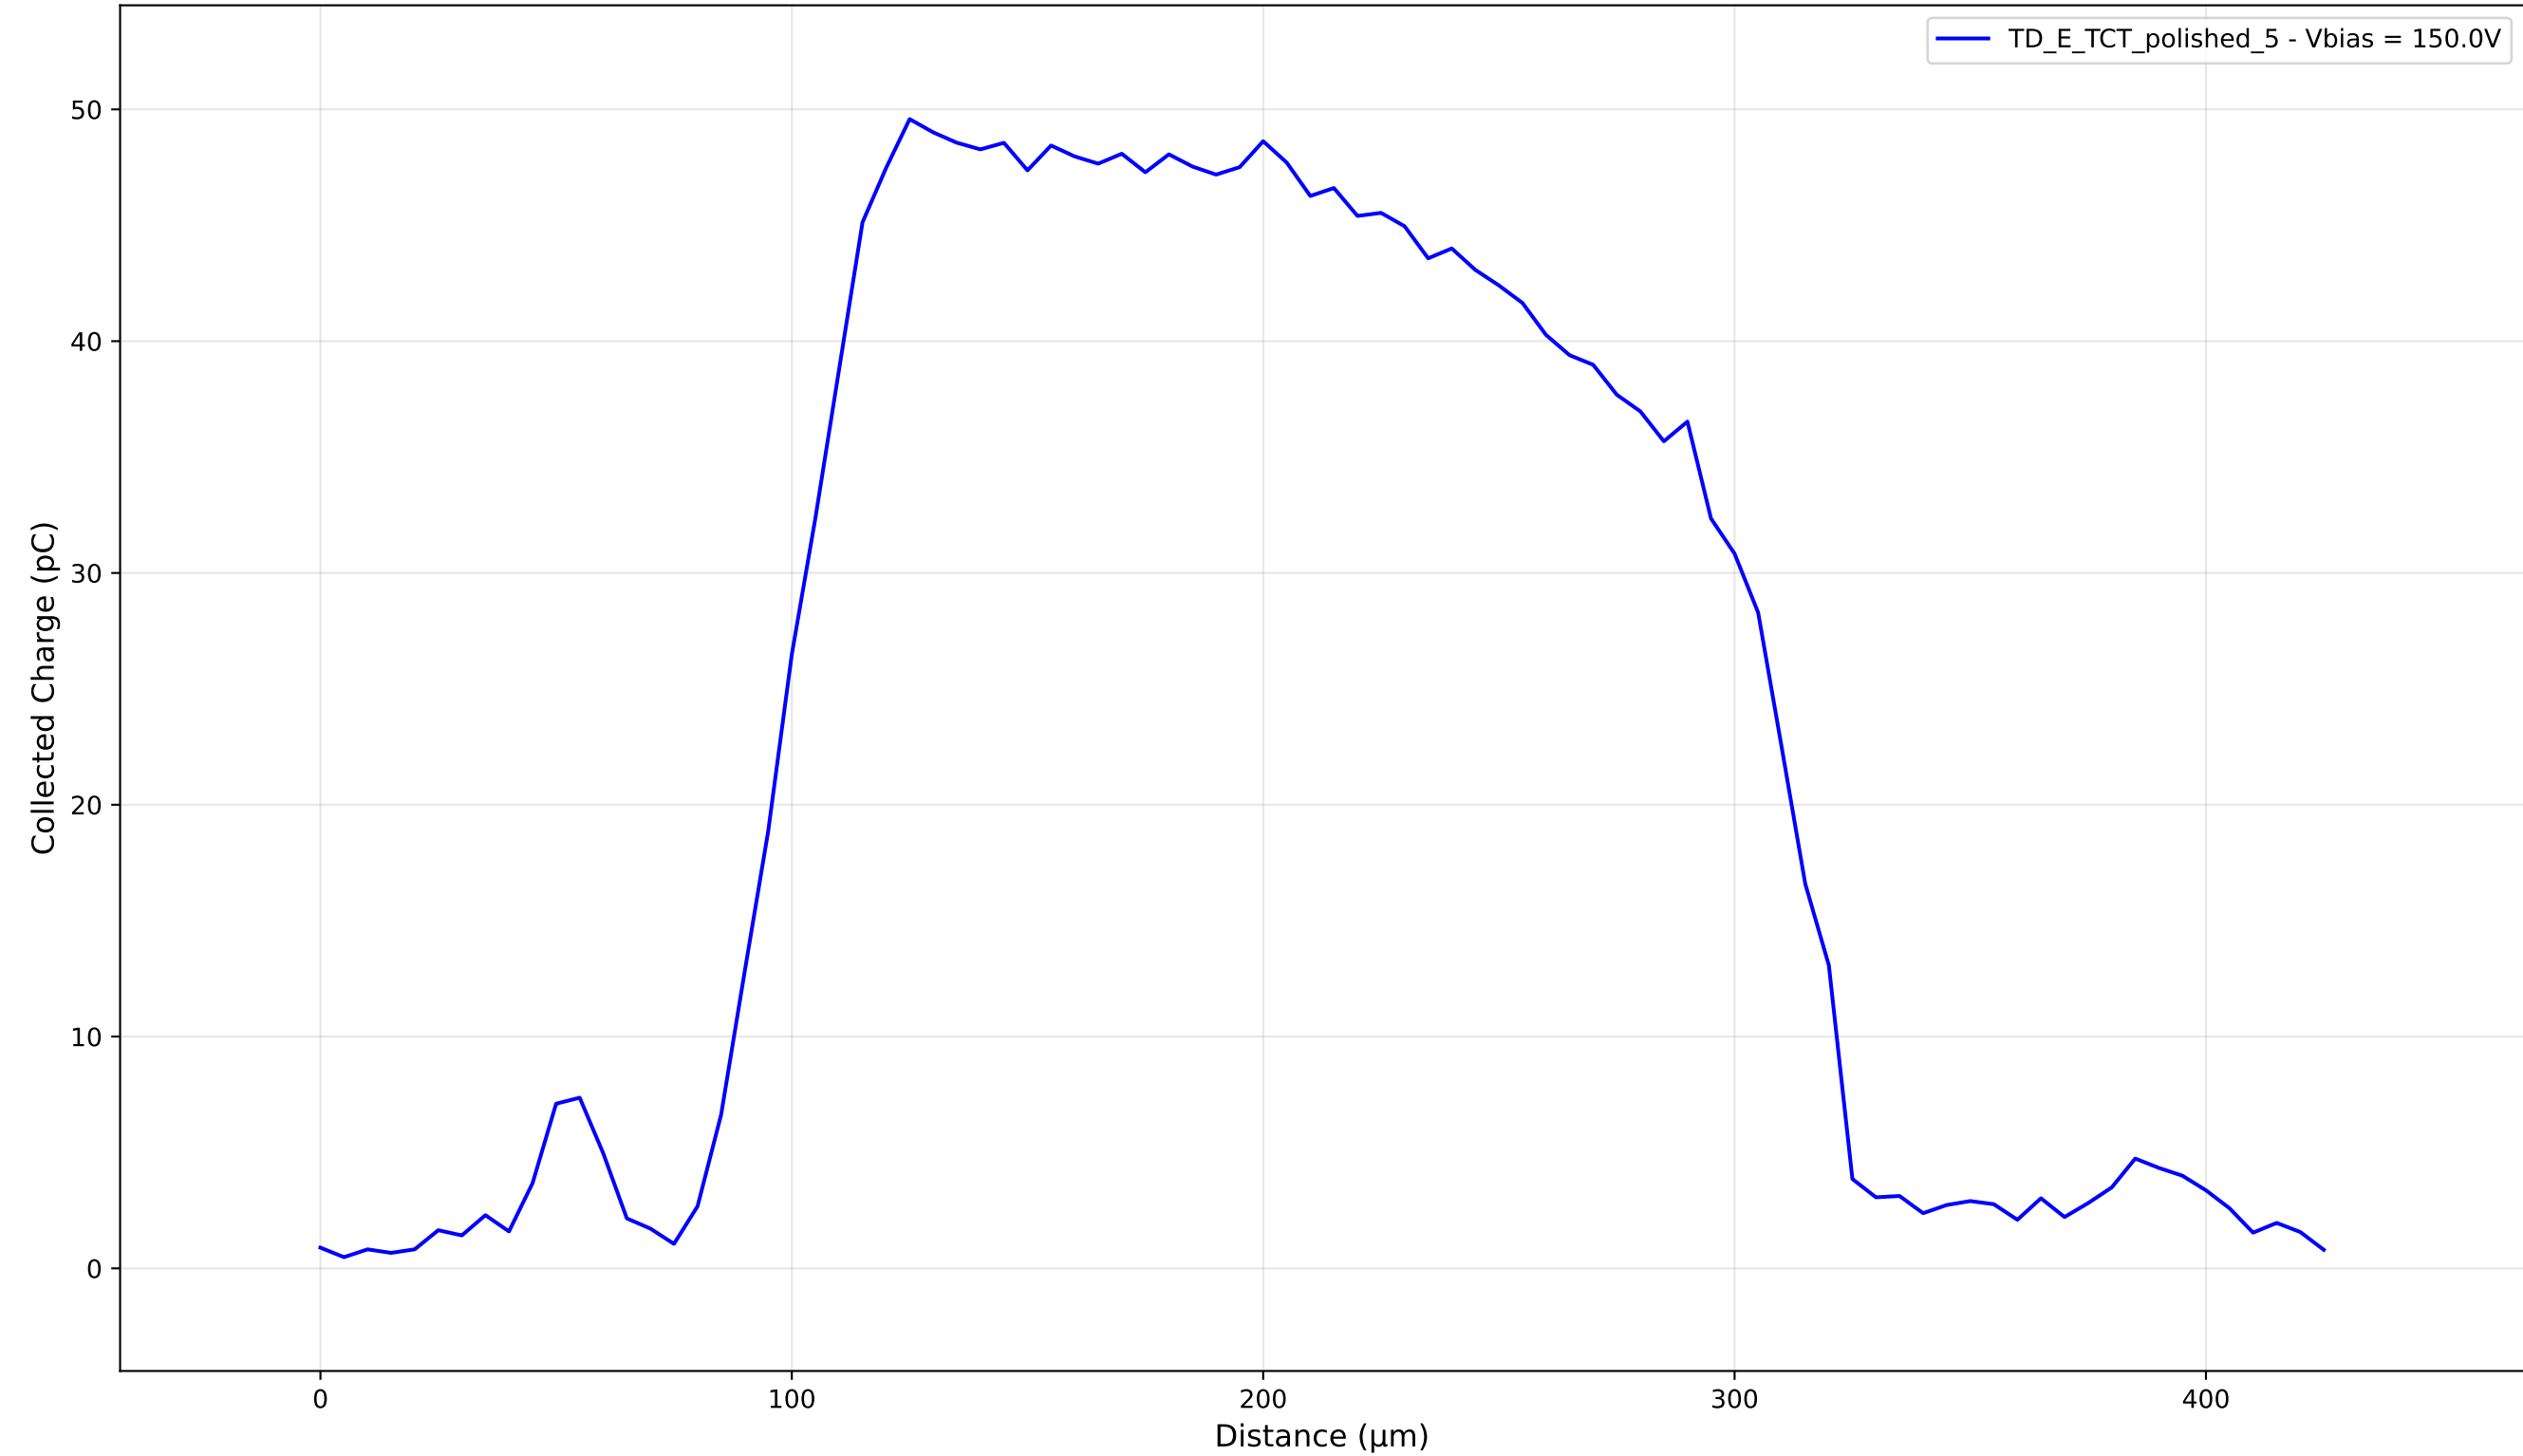


Collected Charge

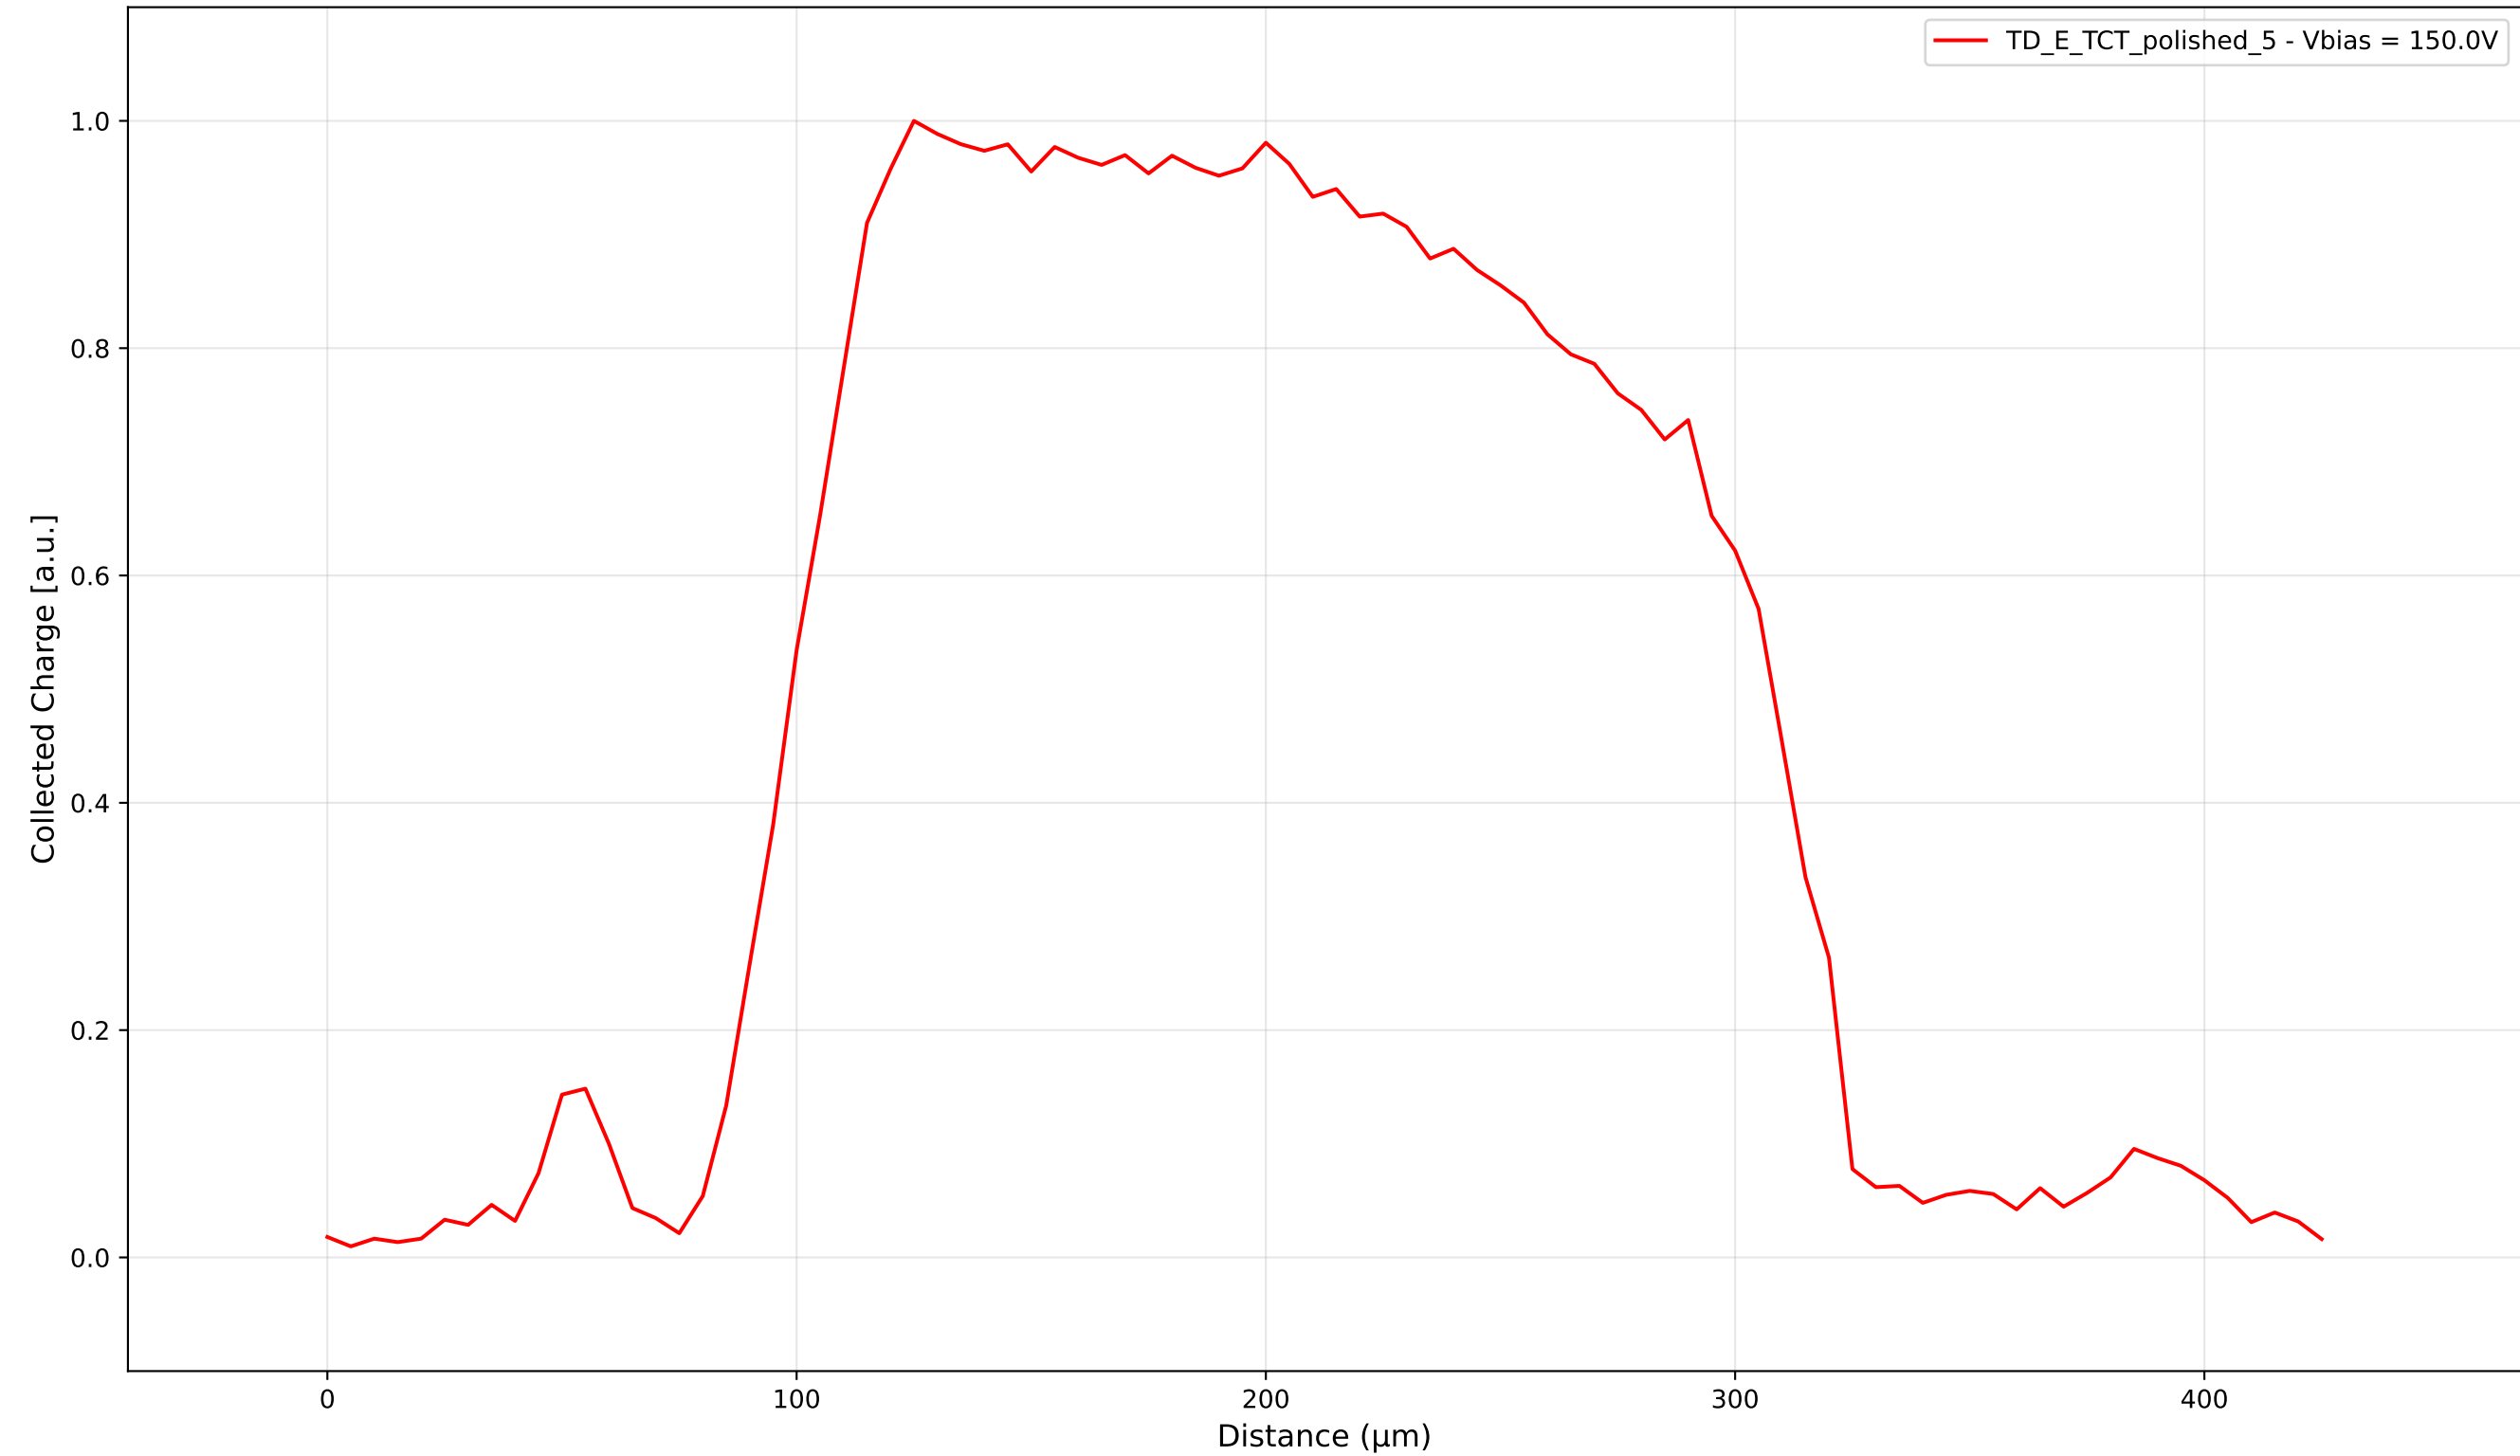


Rise Time

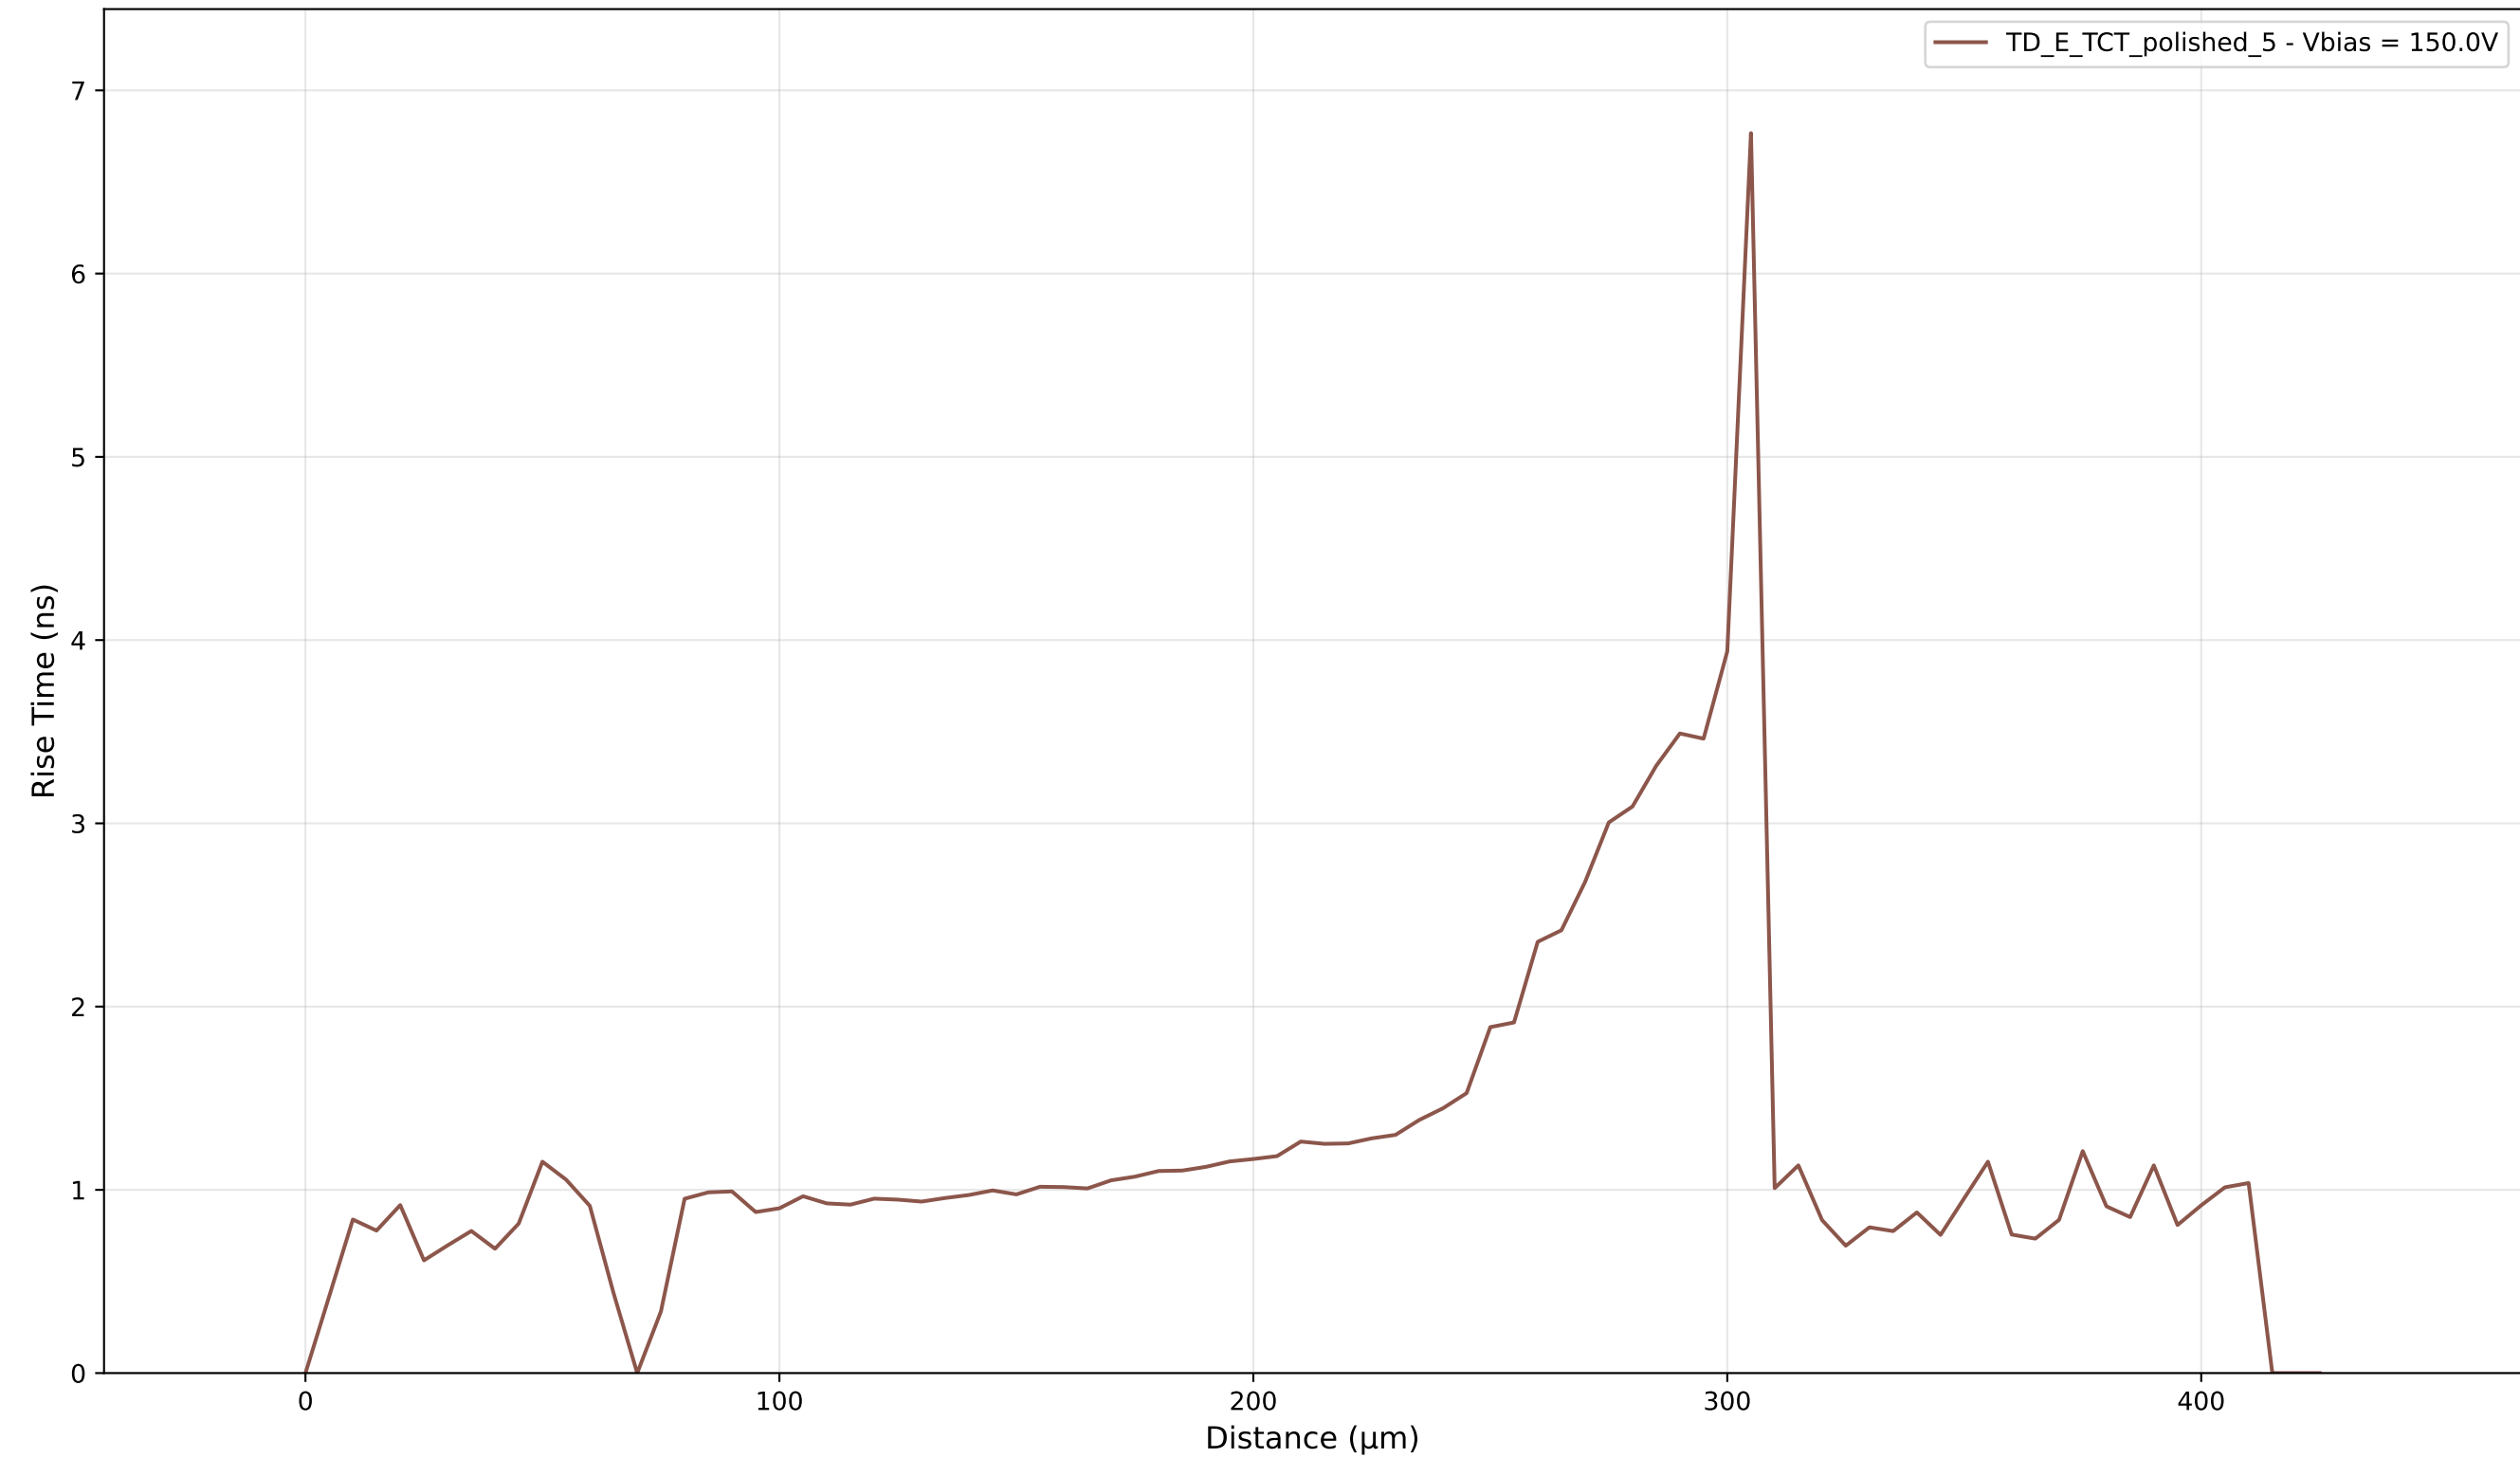


Amplitude

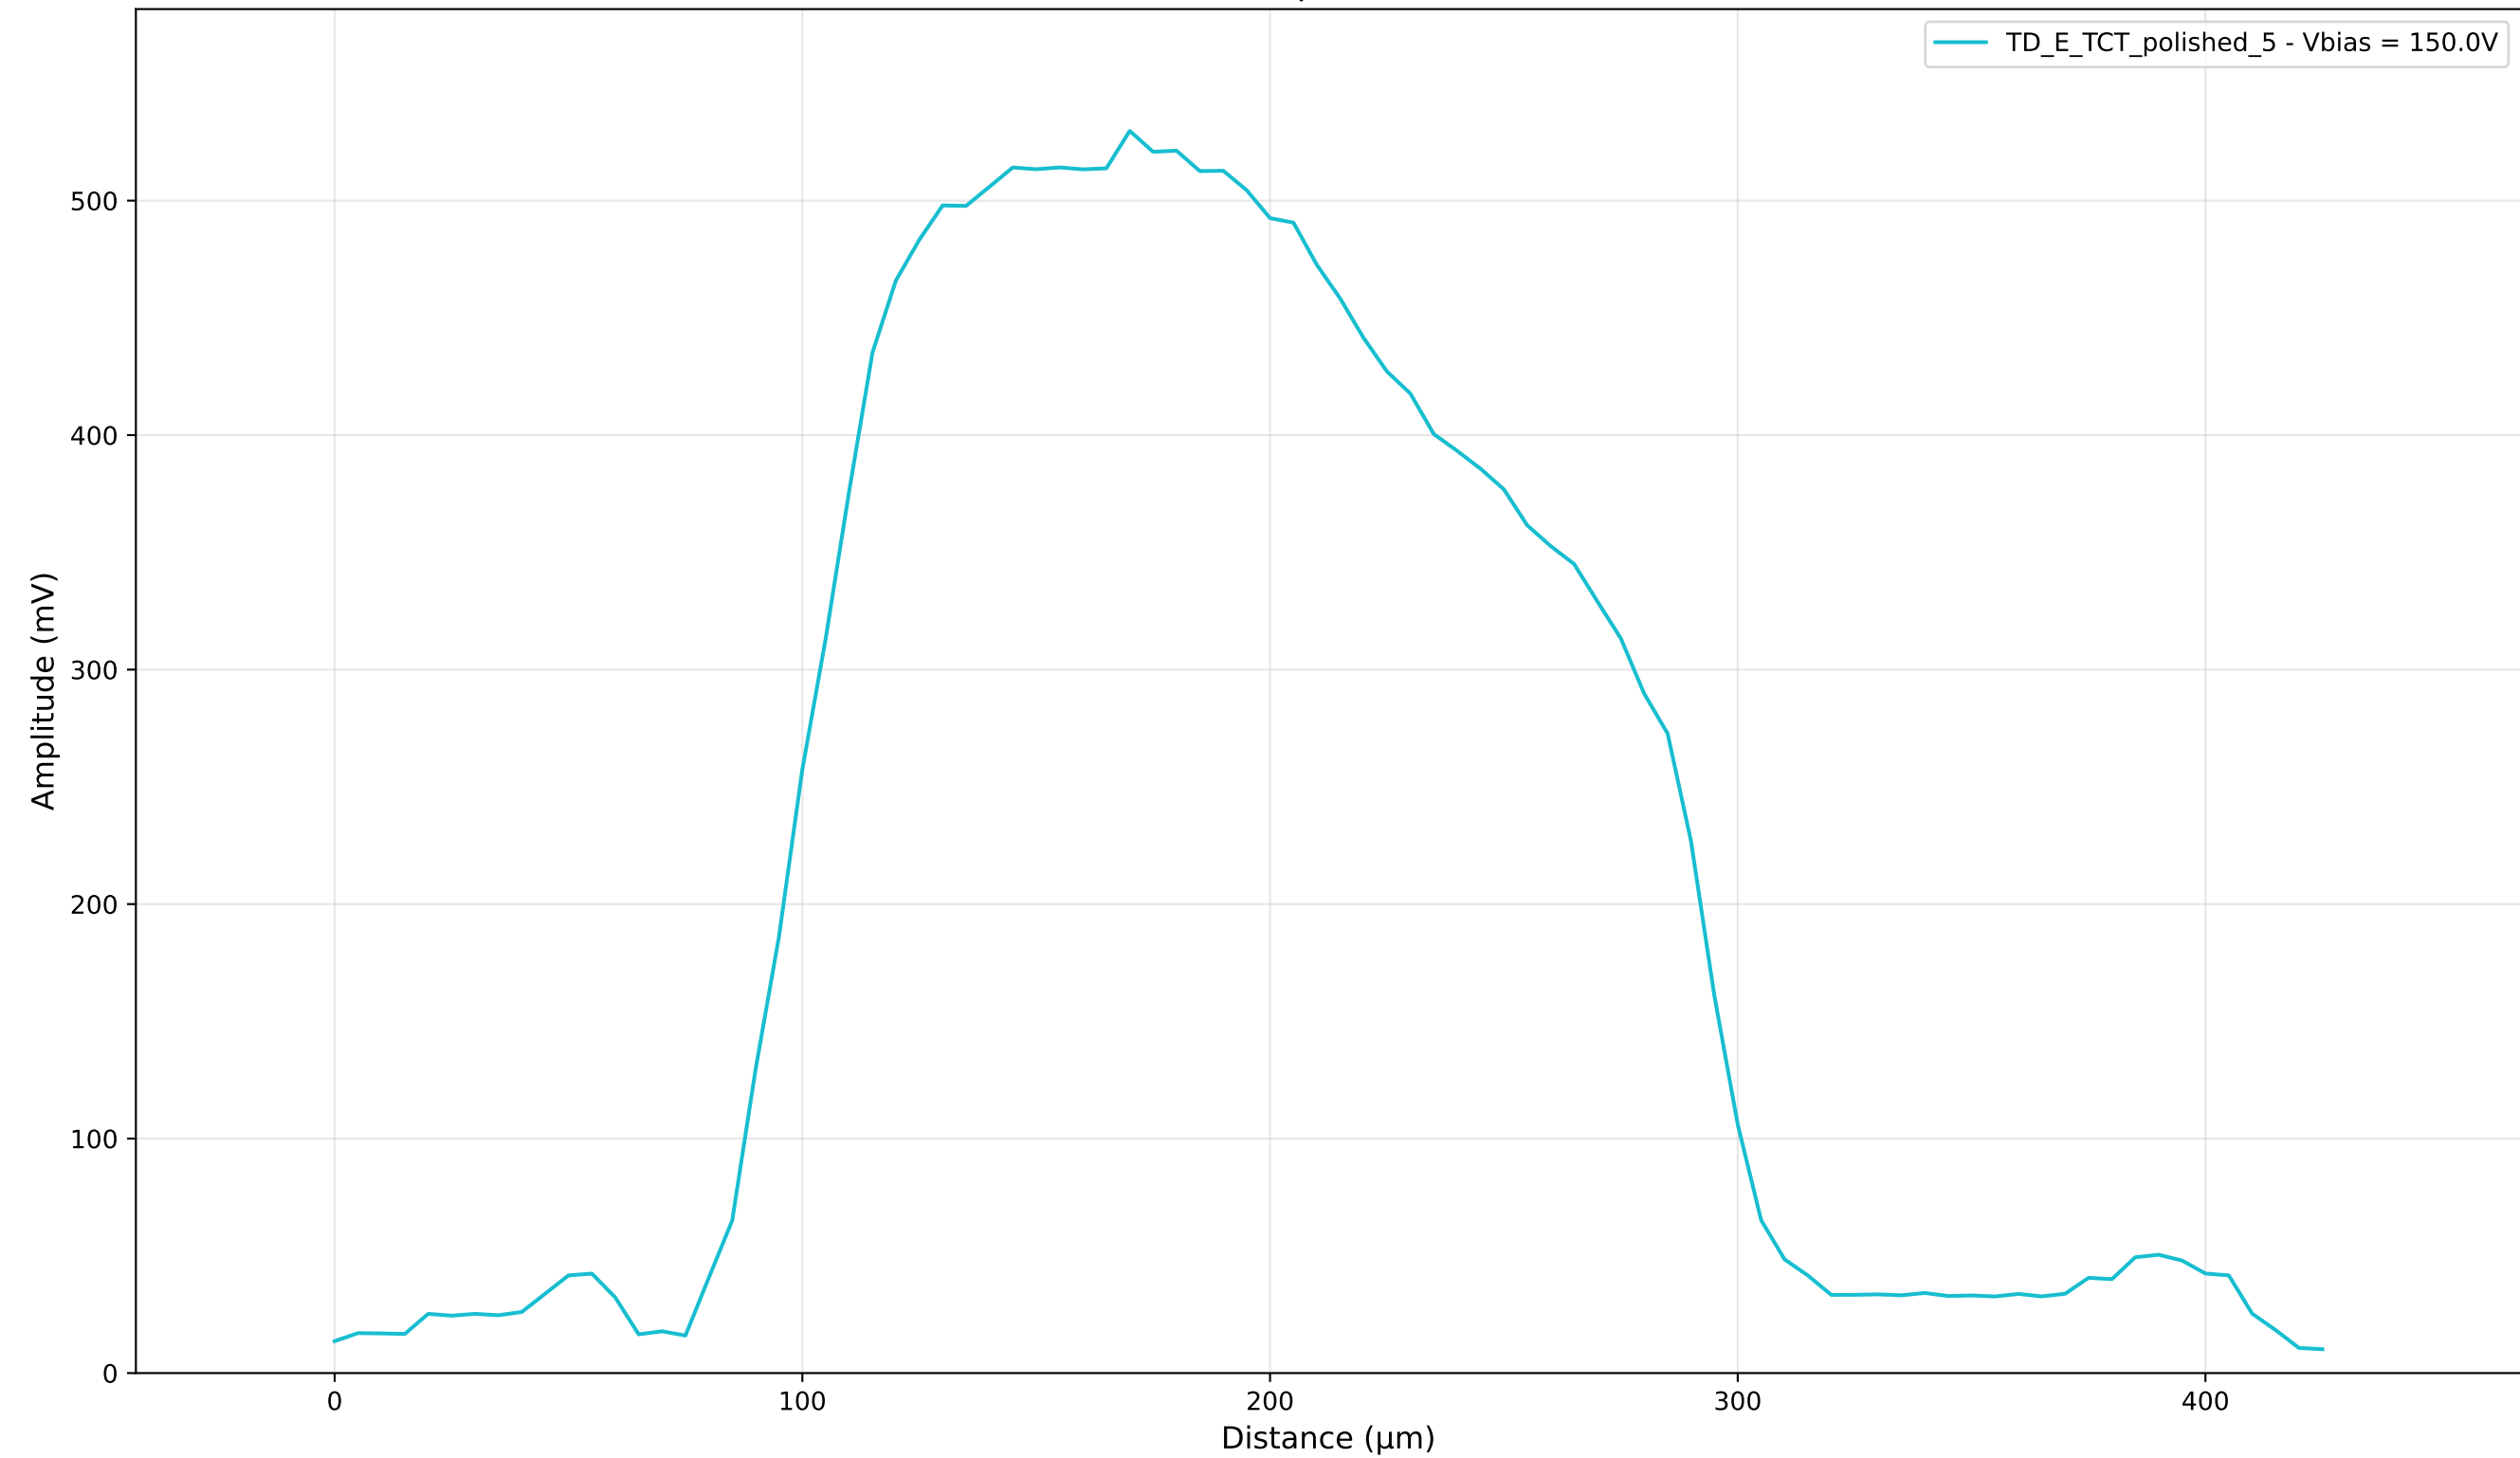


FWHM

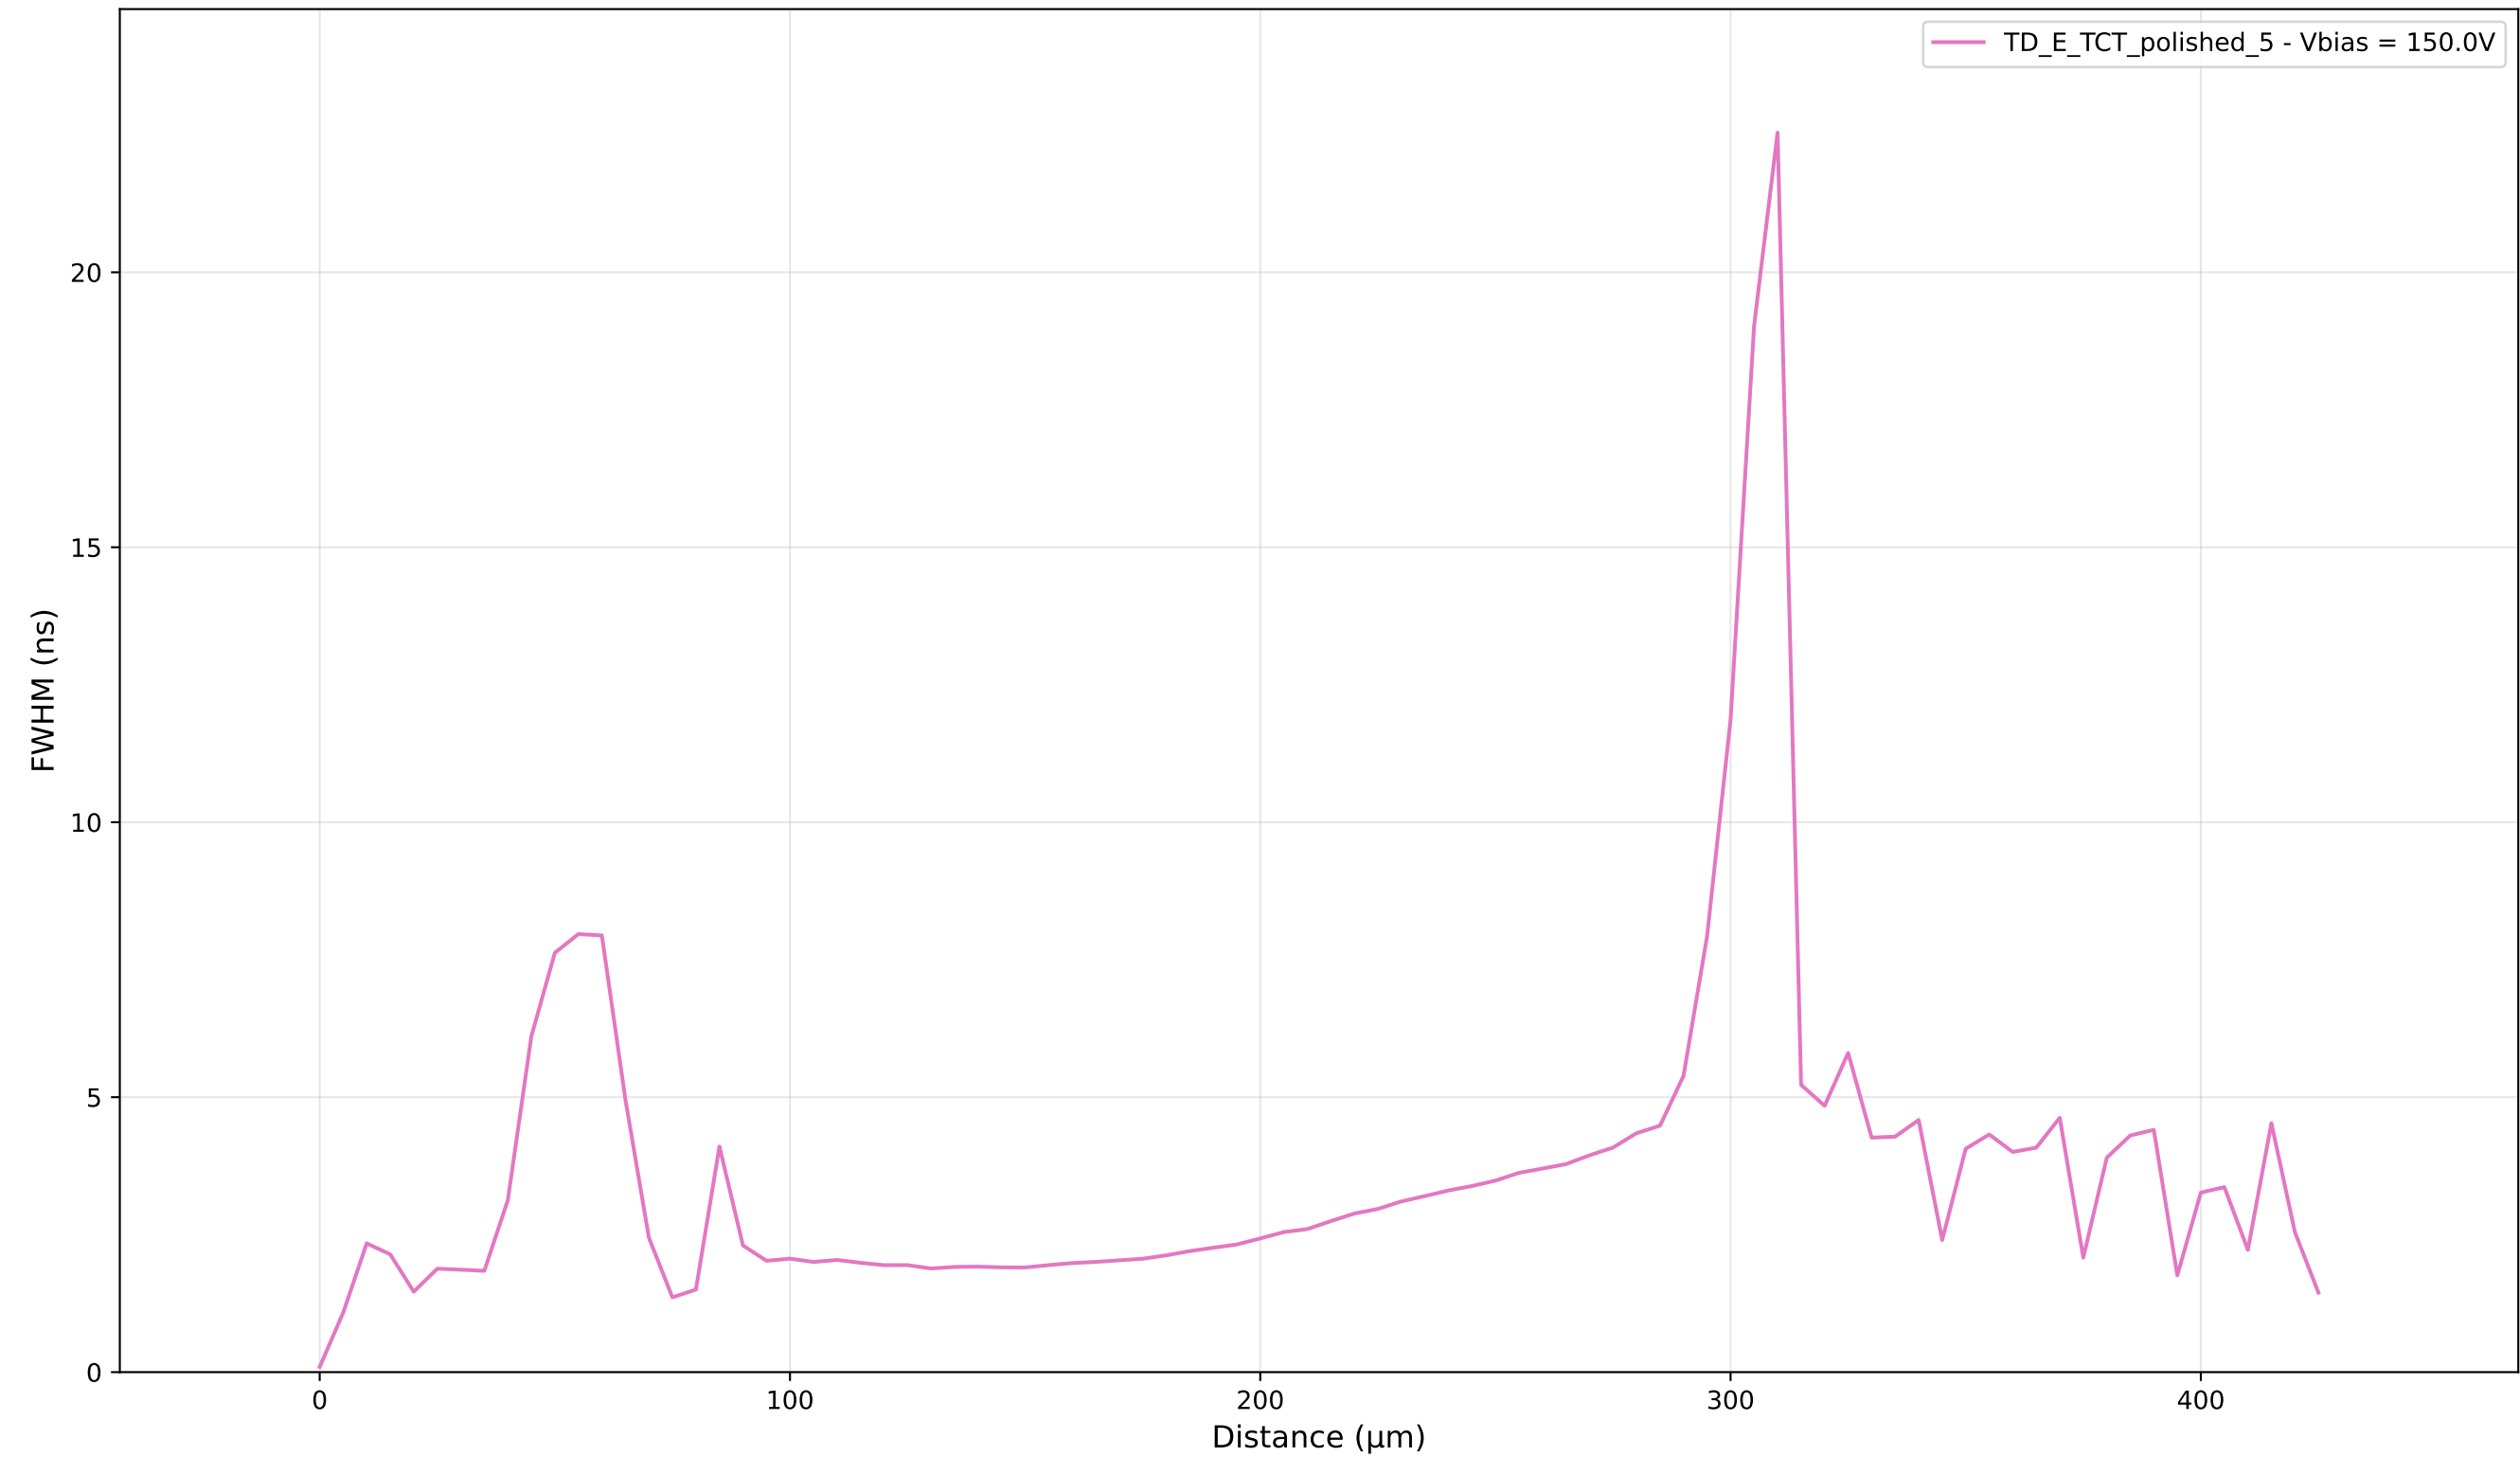


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.89 pC - Rise Time: 0.00 ns (N/A)

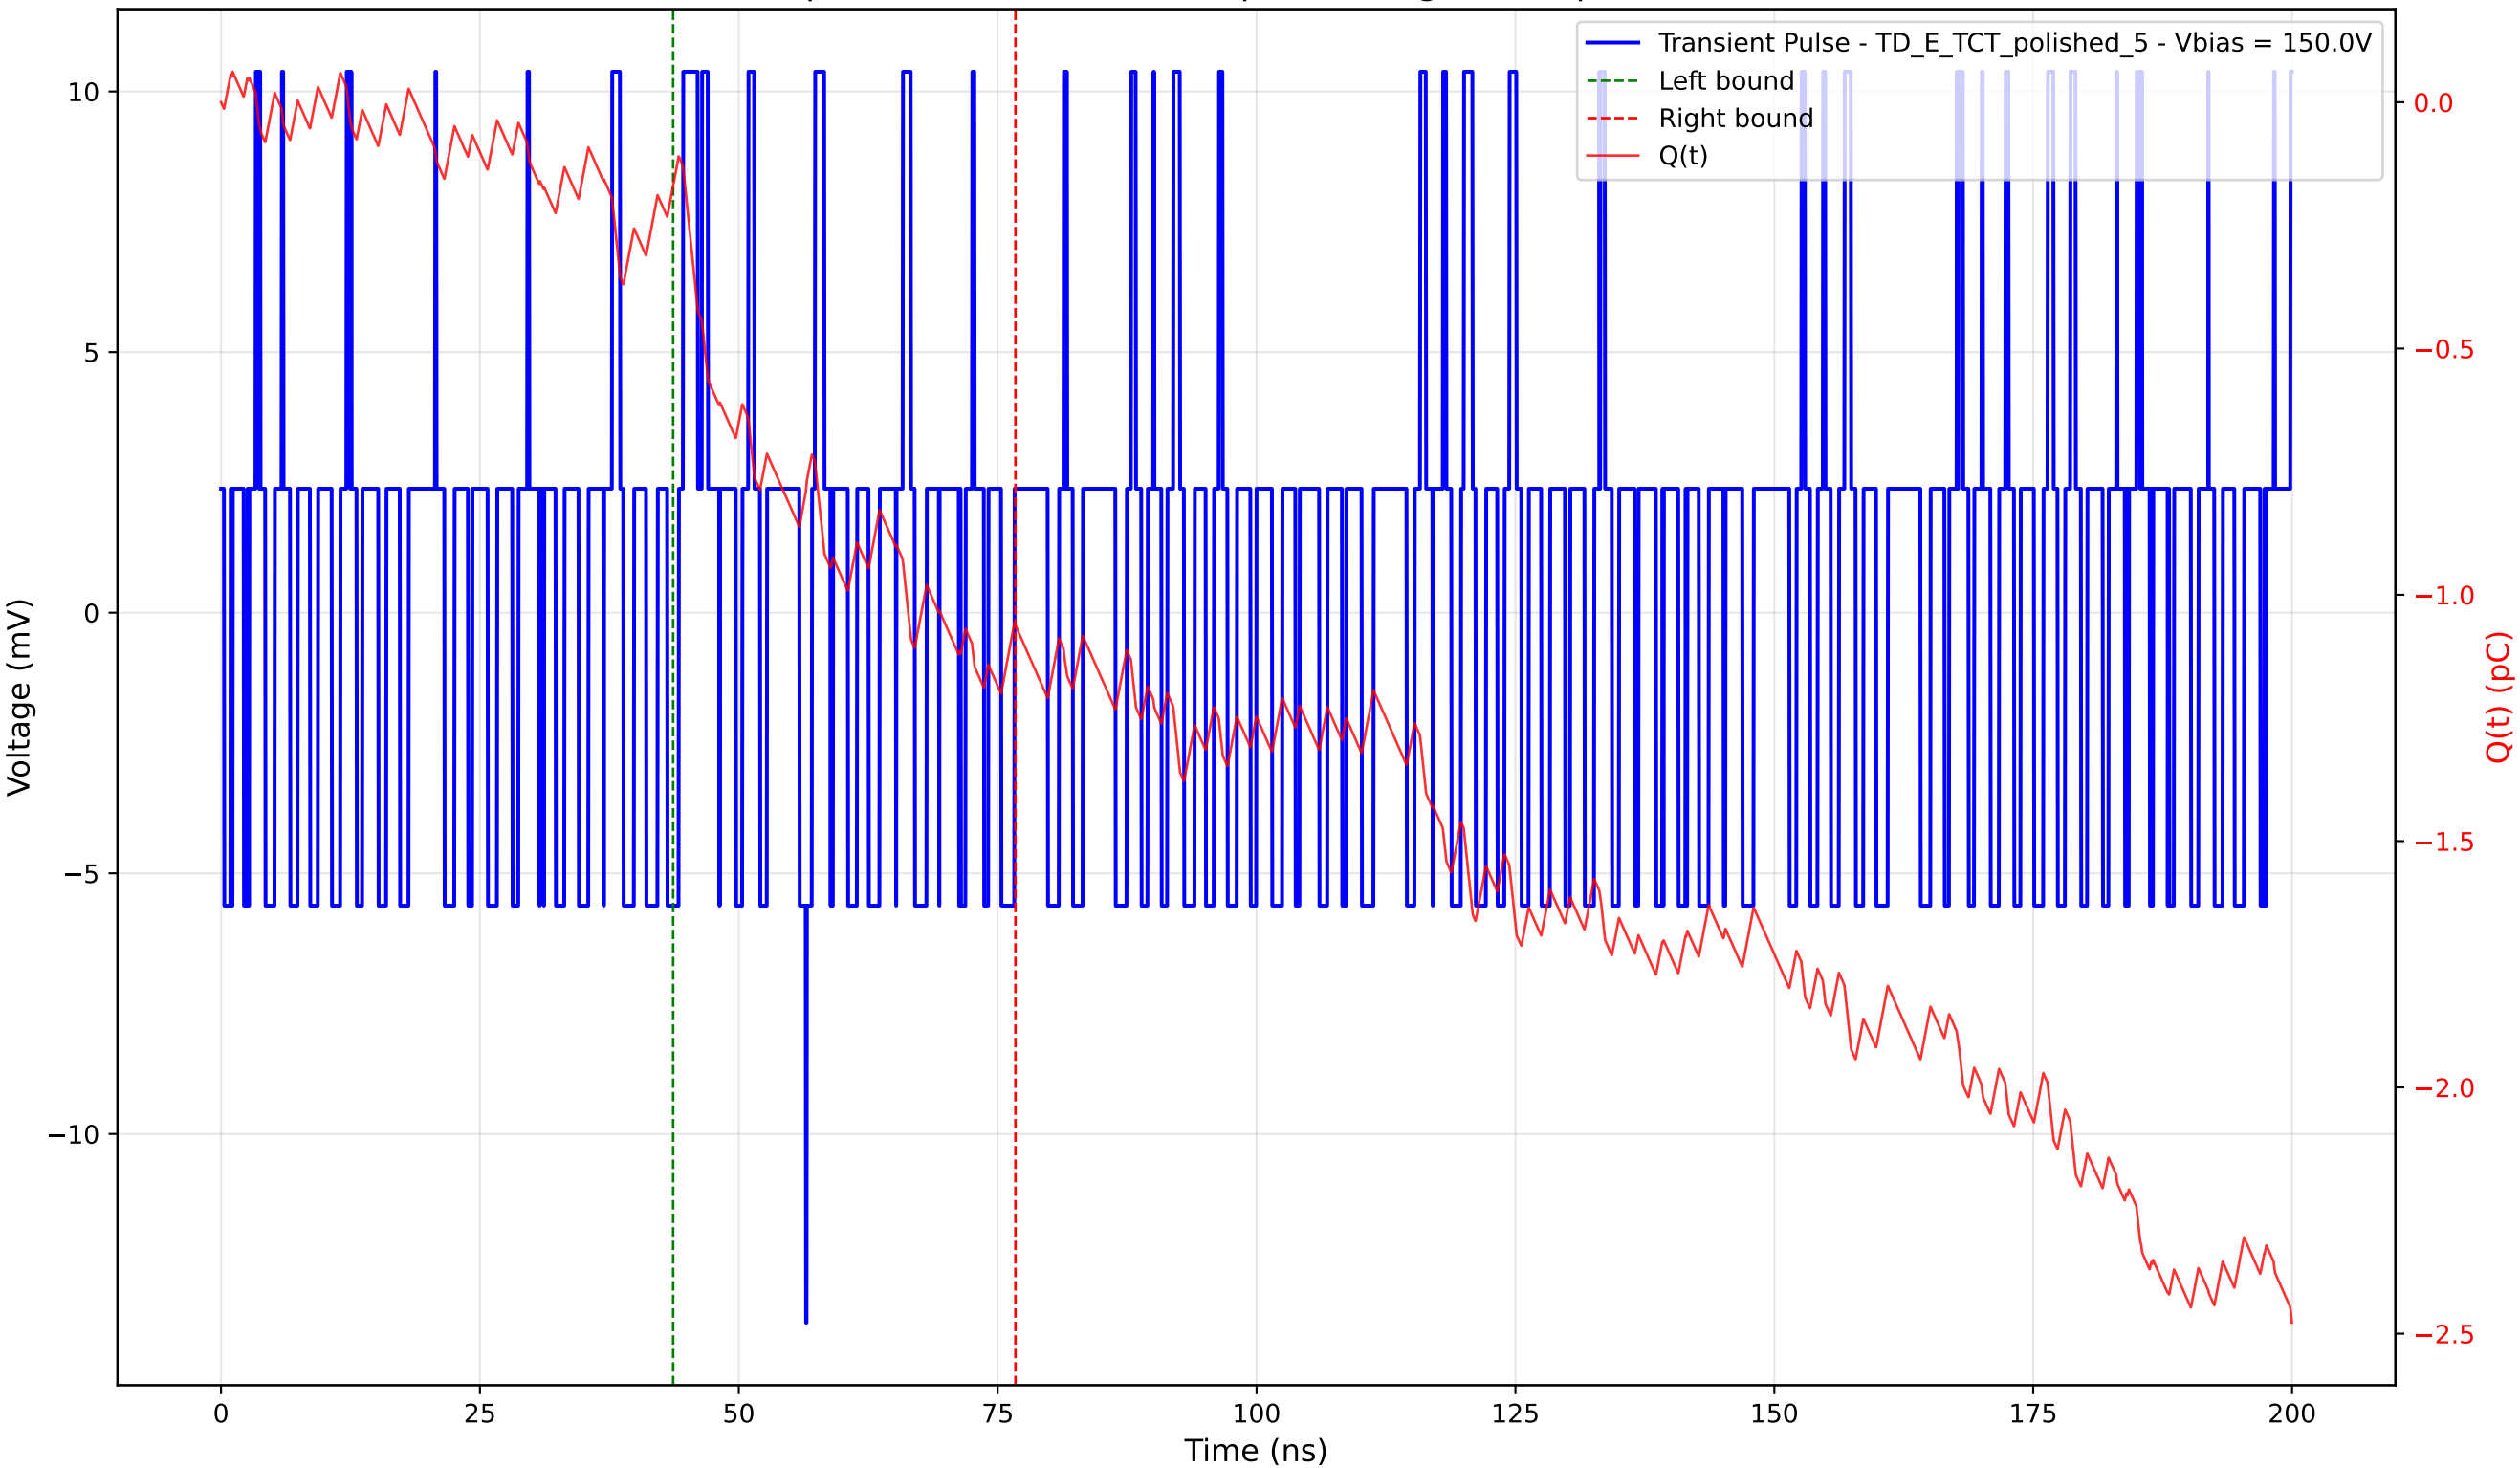


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.48 pC - Rise Time: 0.42 ns

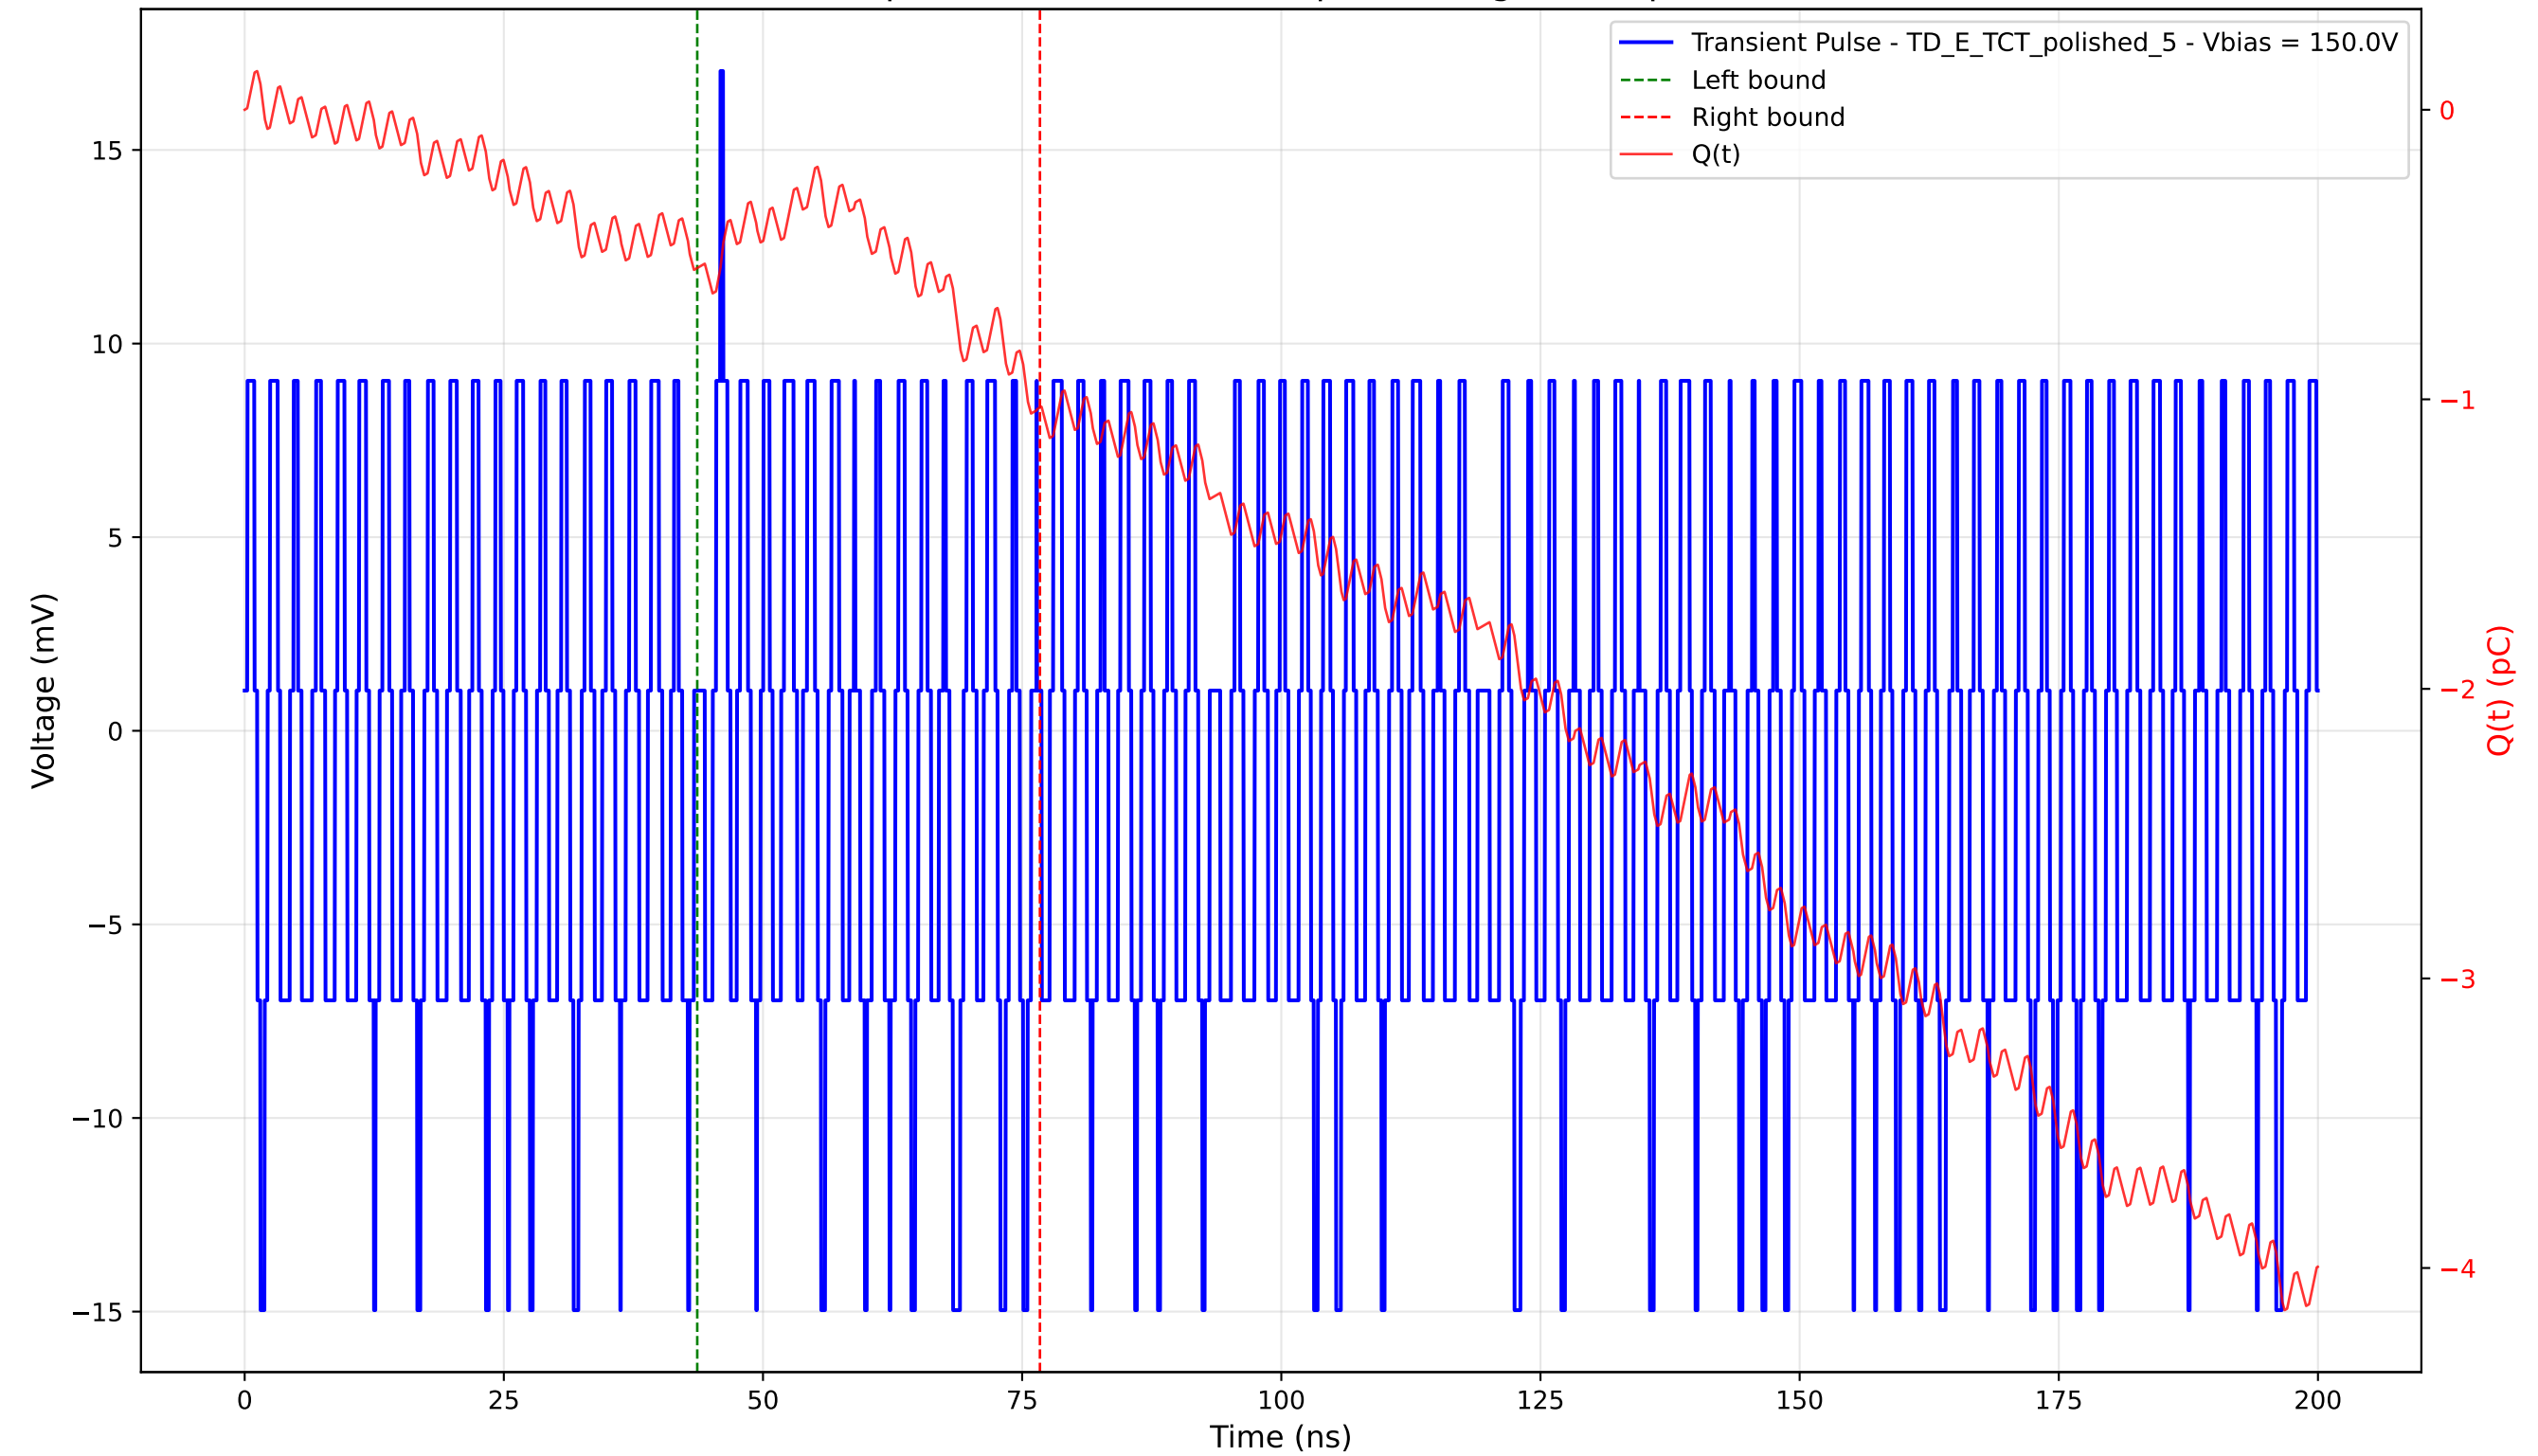


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.82 pC - Rise Time: 0.84 ns

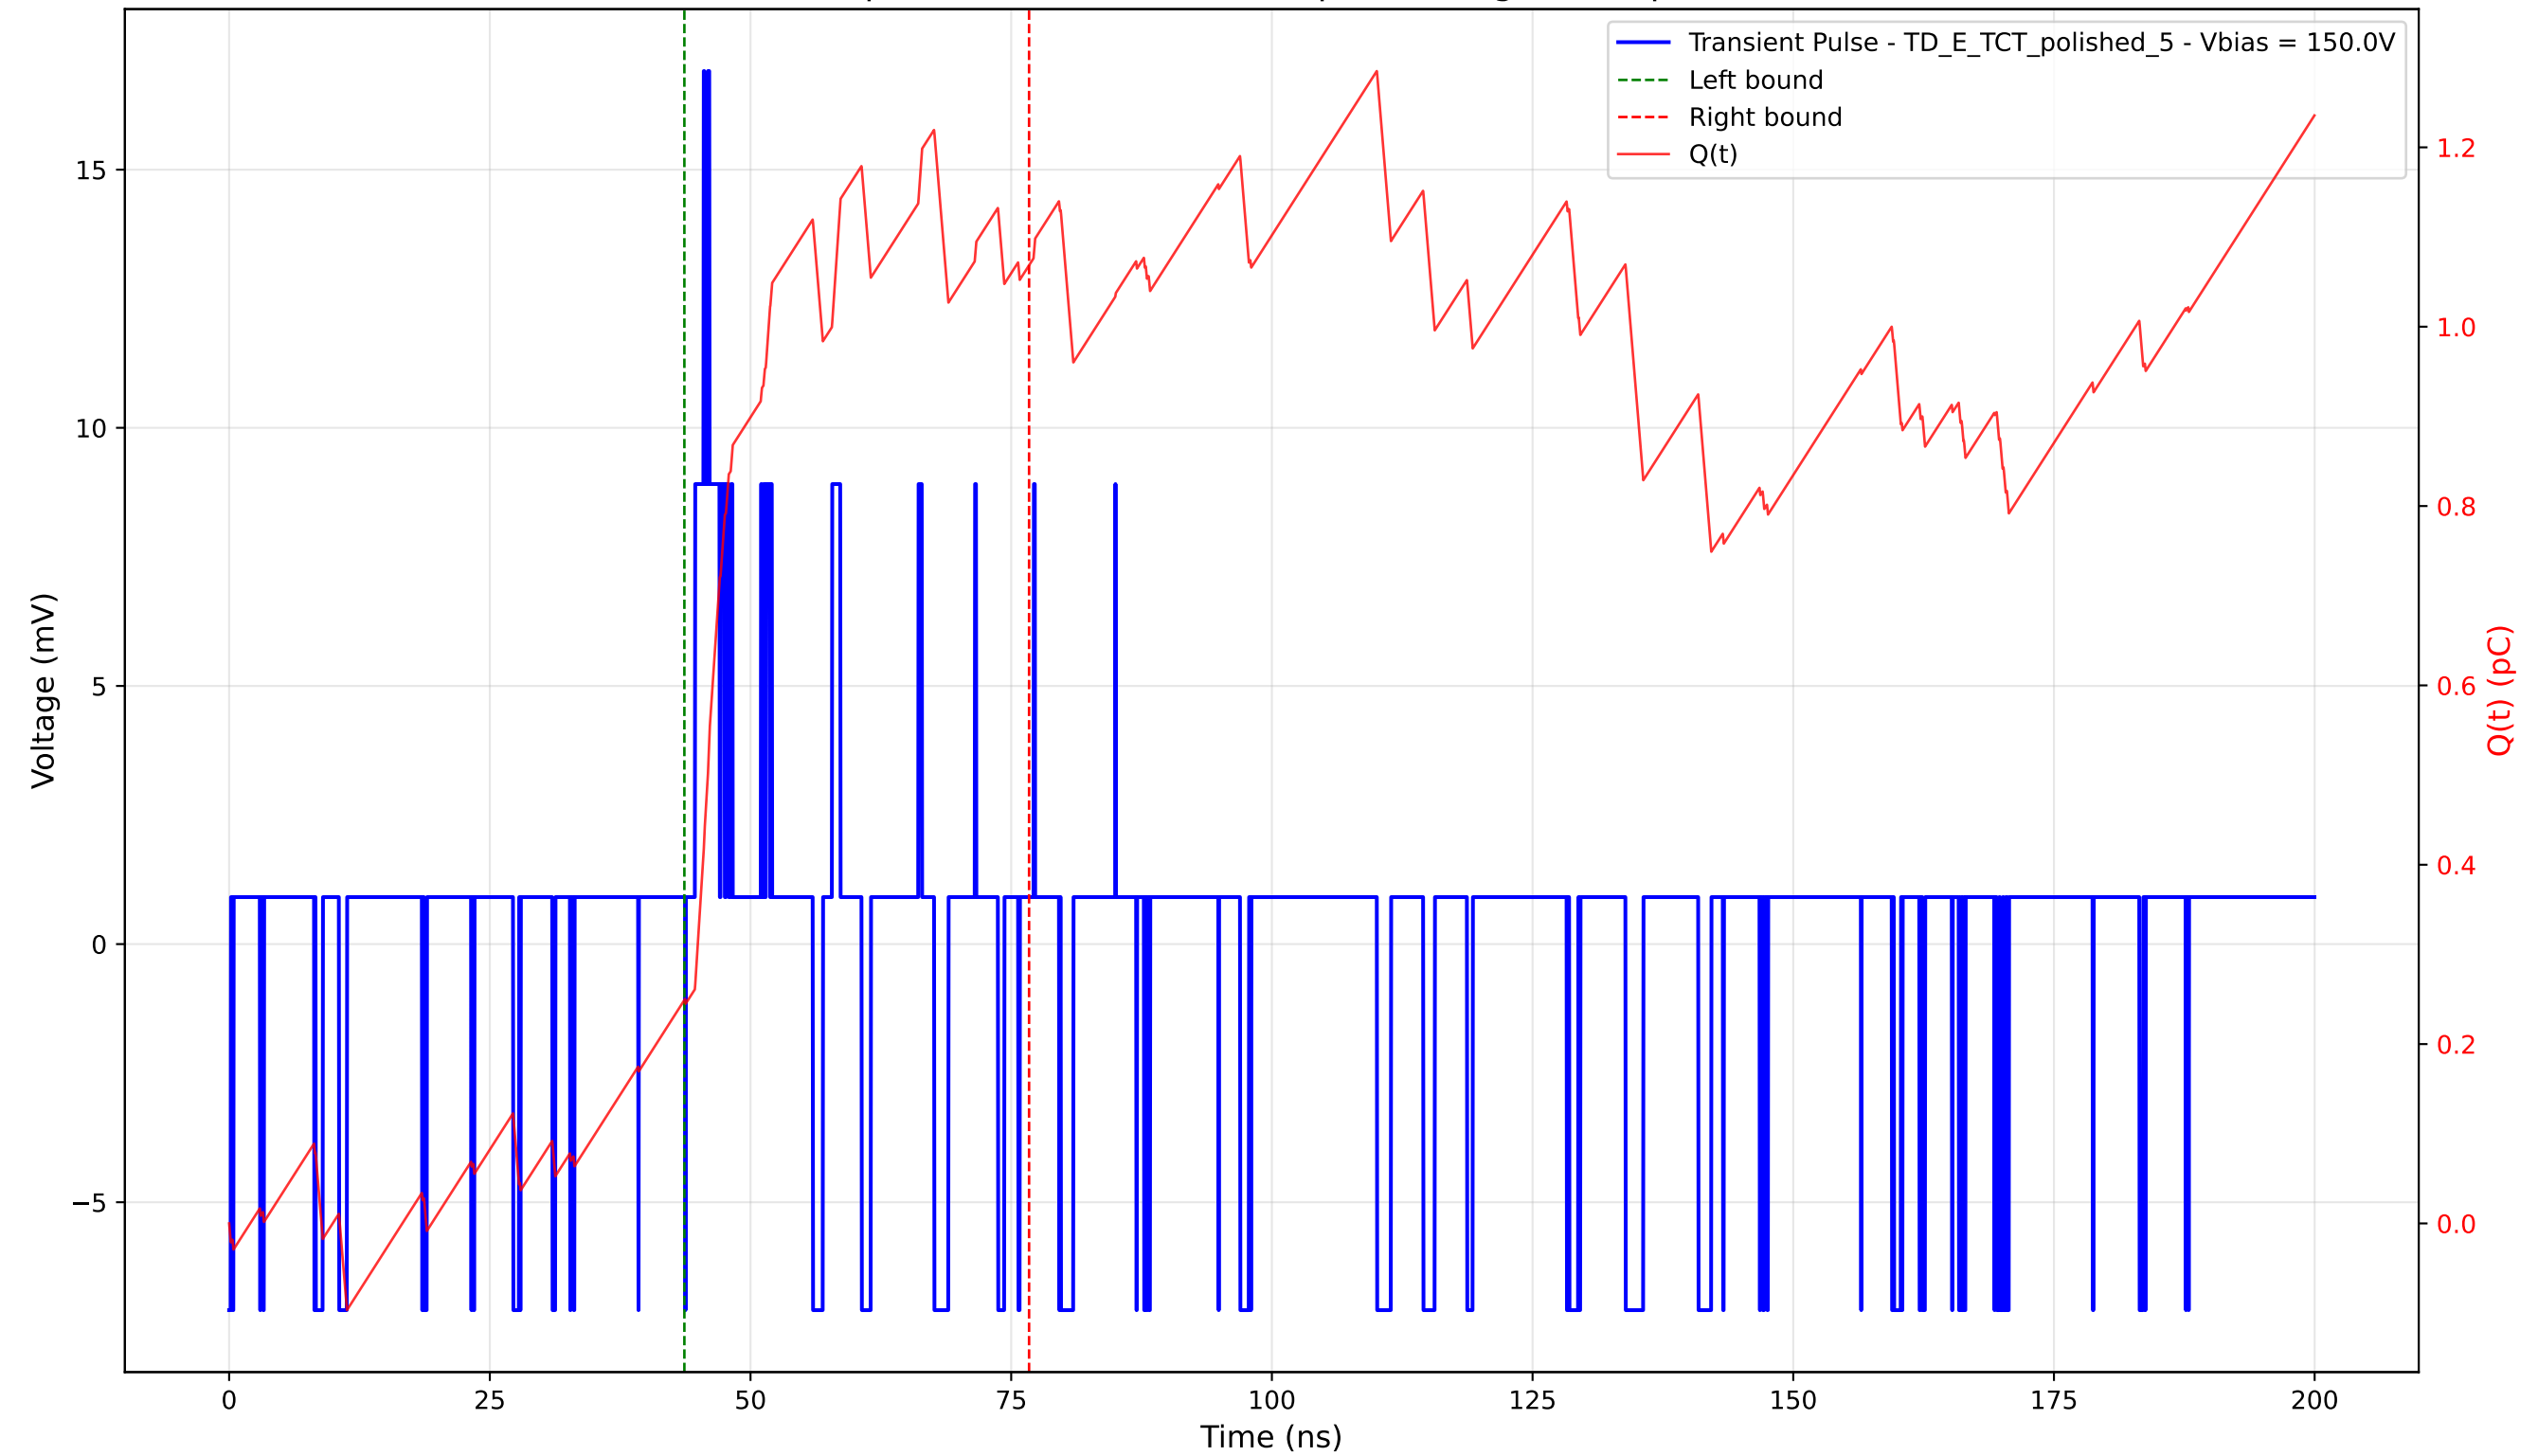


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 0.67 pC - Rise Time: 0.78 ns

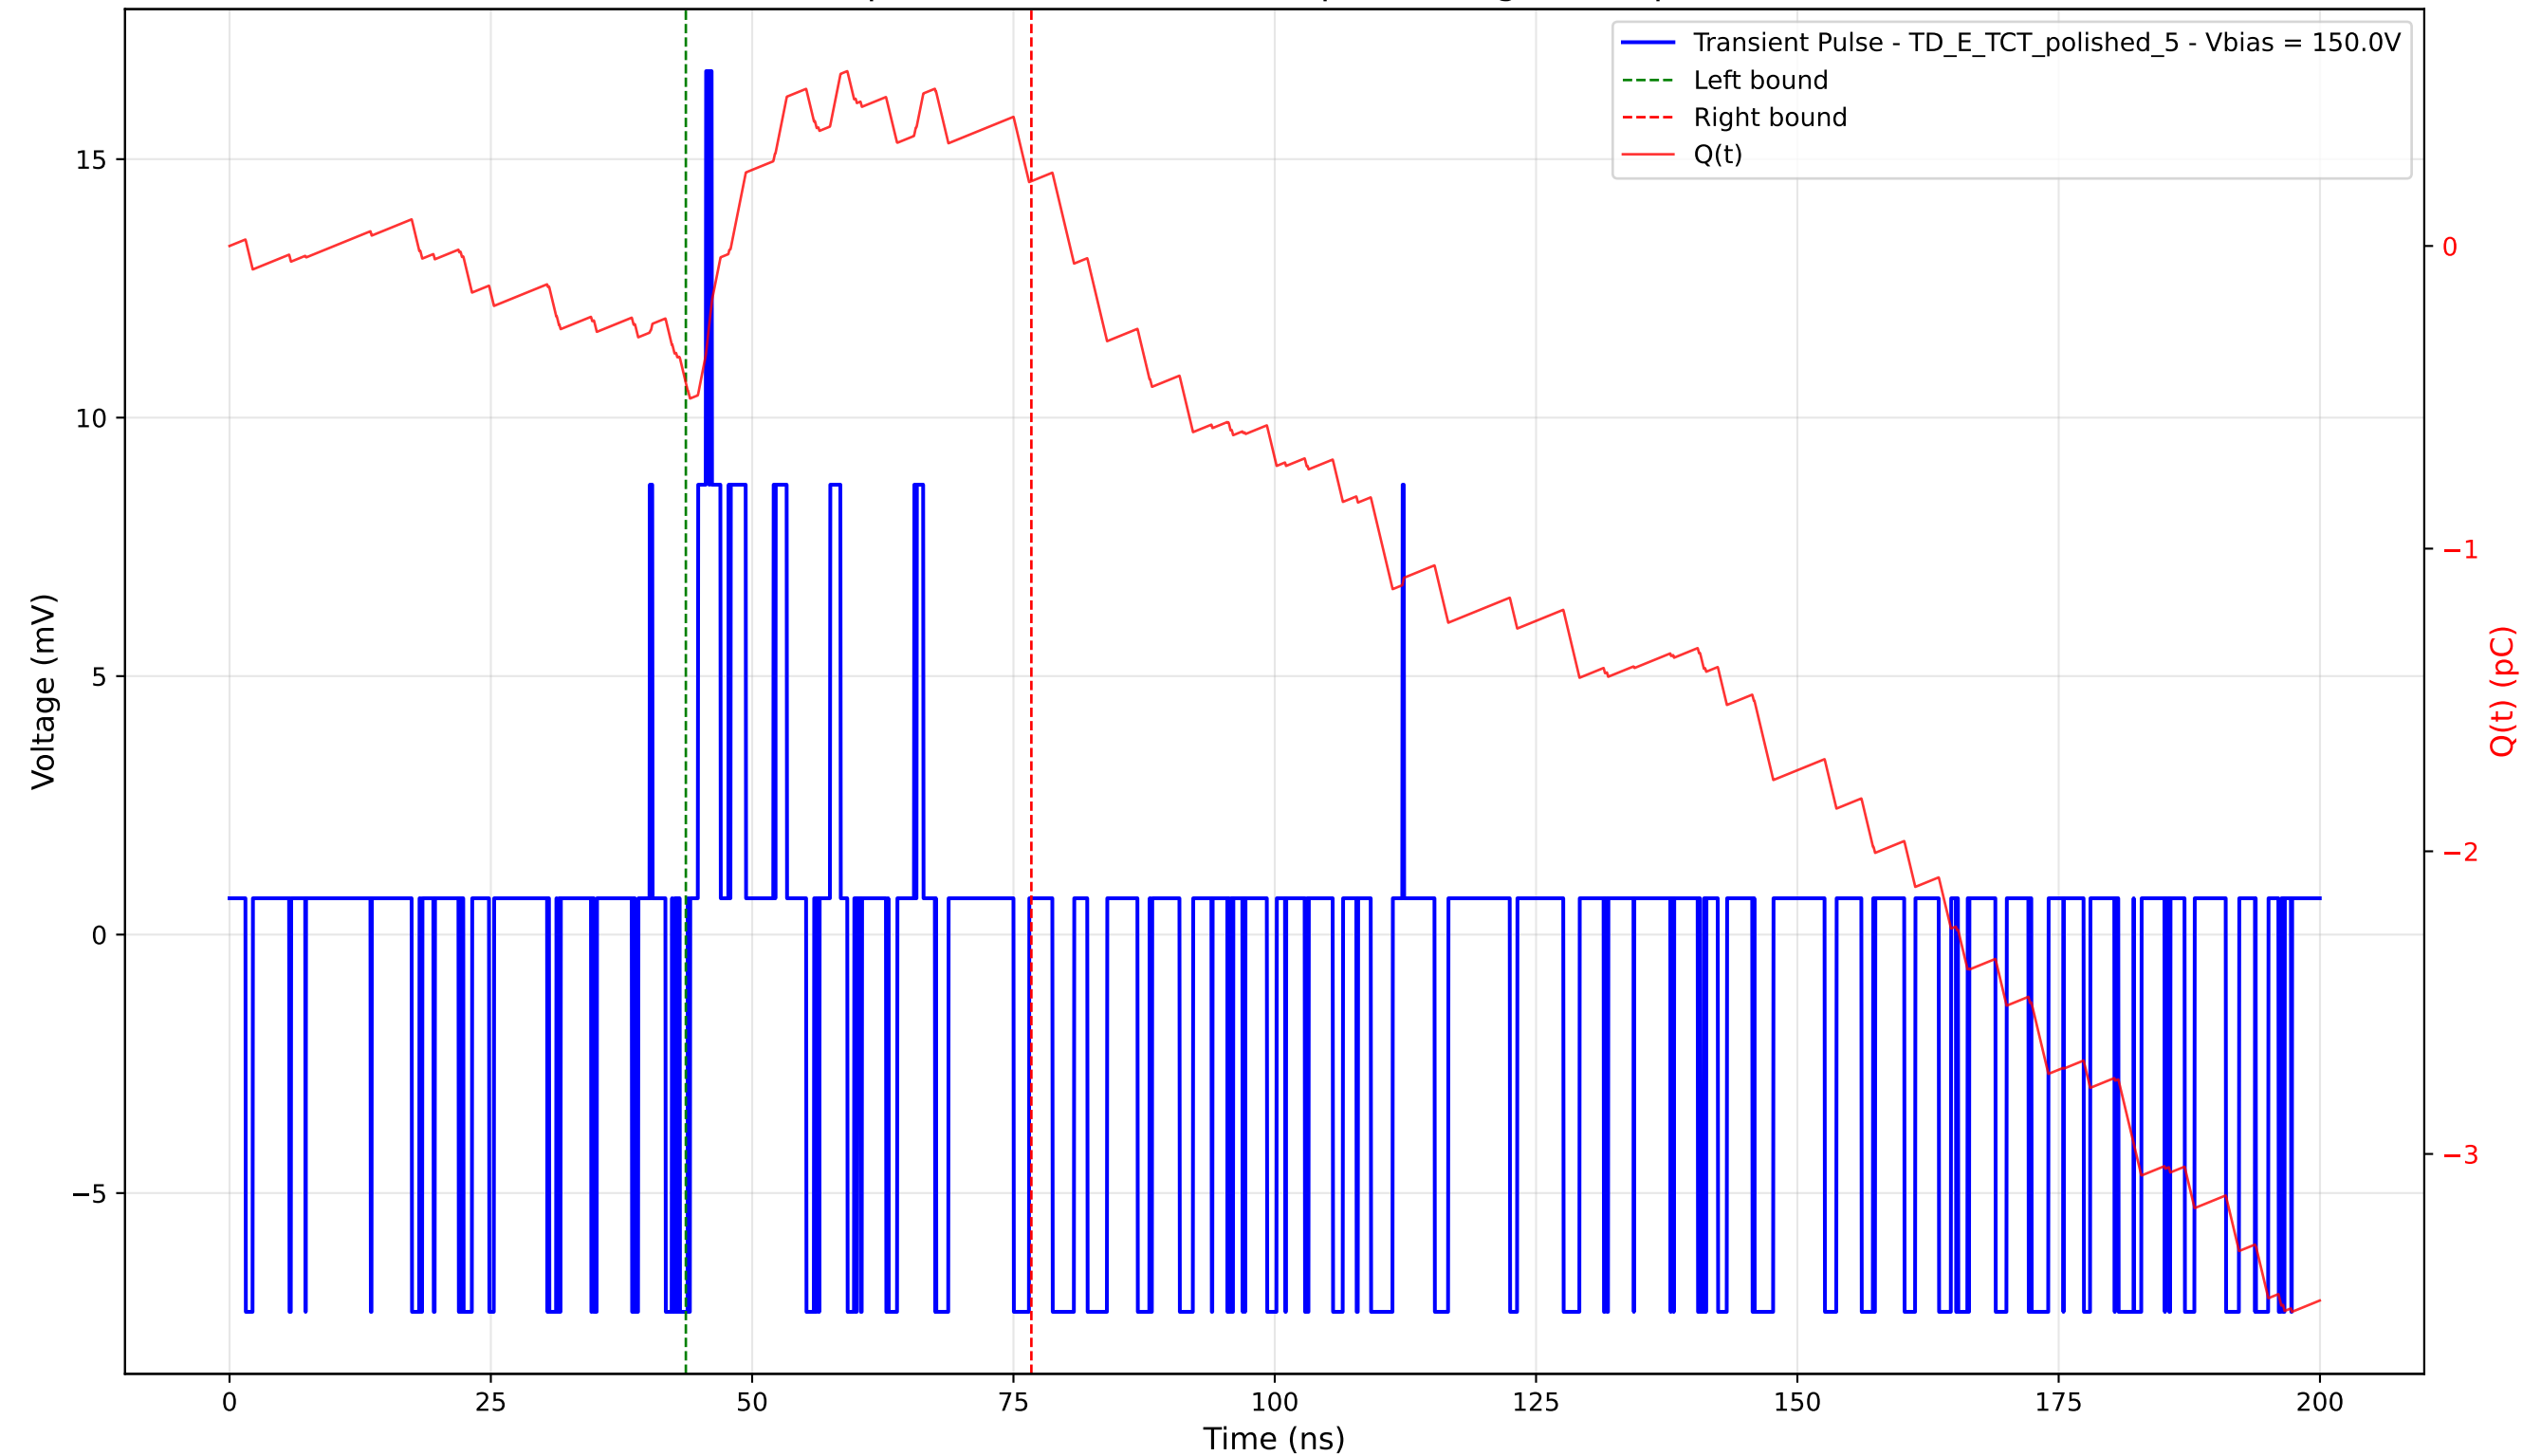


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 0.82 pC - Rise Time: 0.92 ns

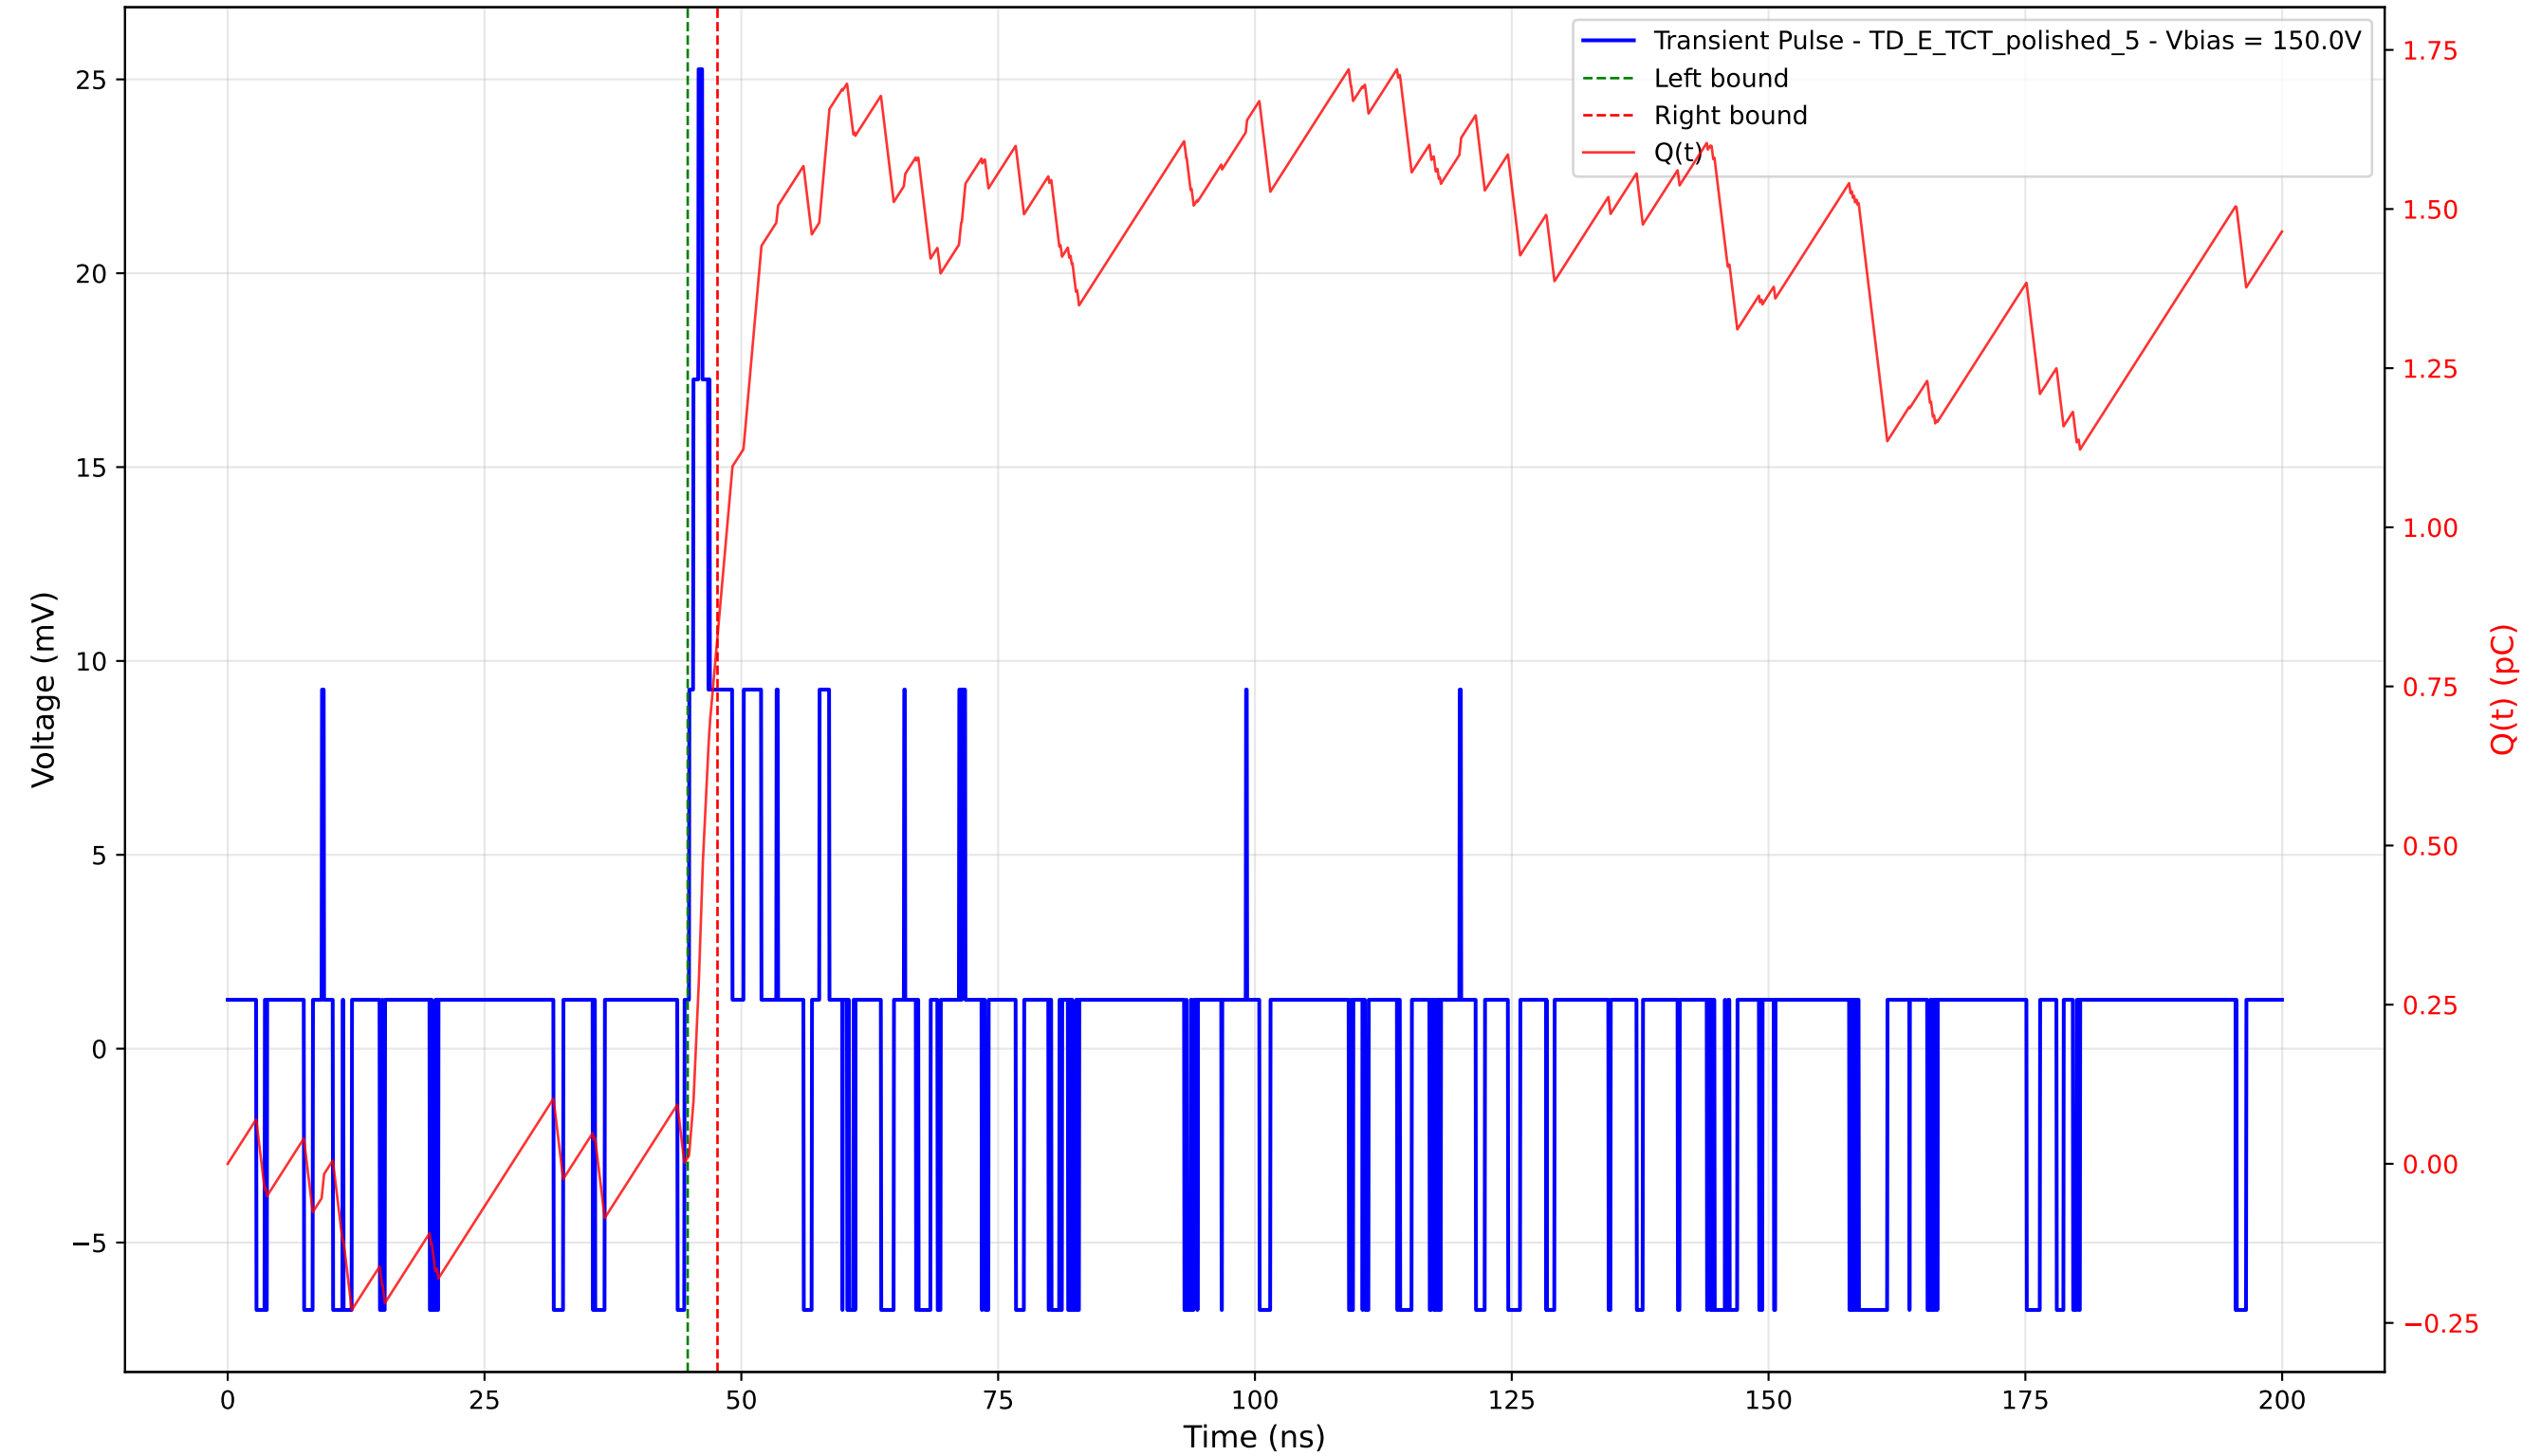


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.65 pC - Rise Time: 0.62 ns

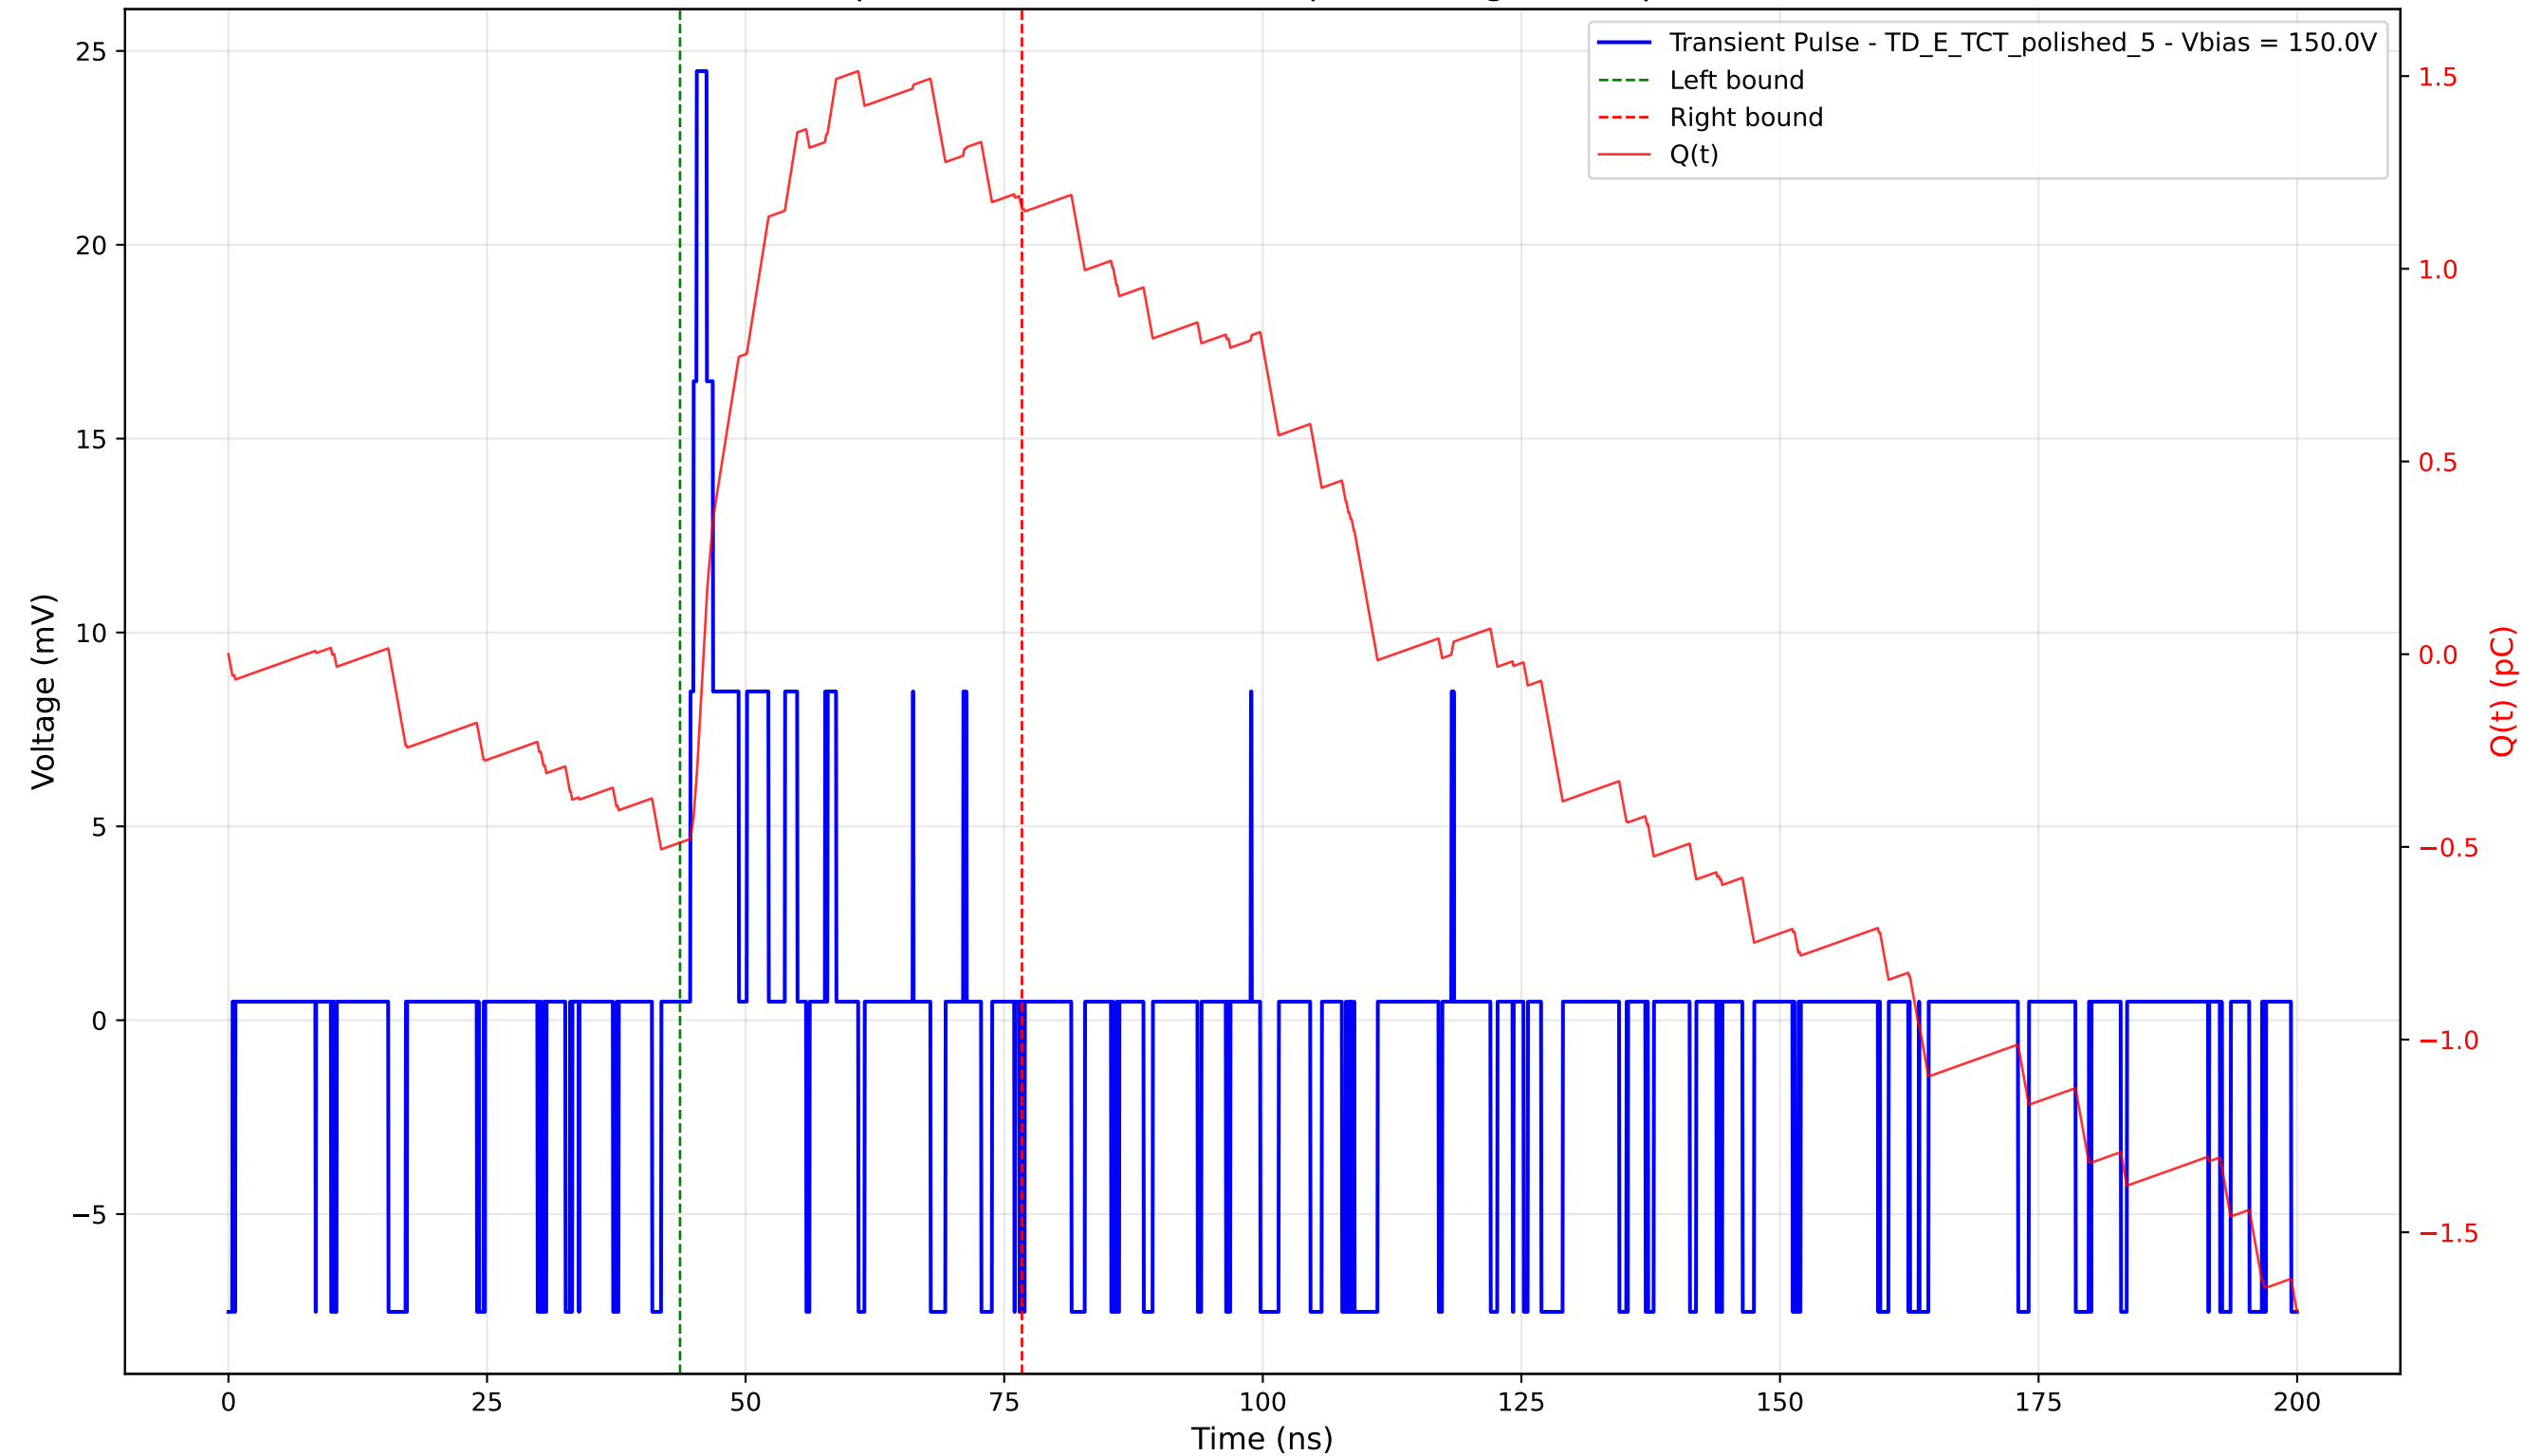


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.42 pC - Rise Time: 0.70 ns

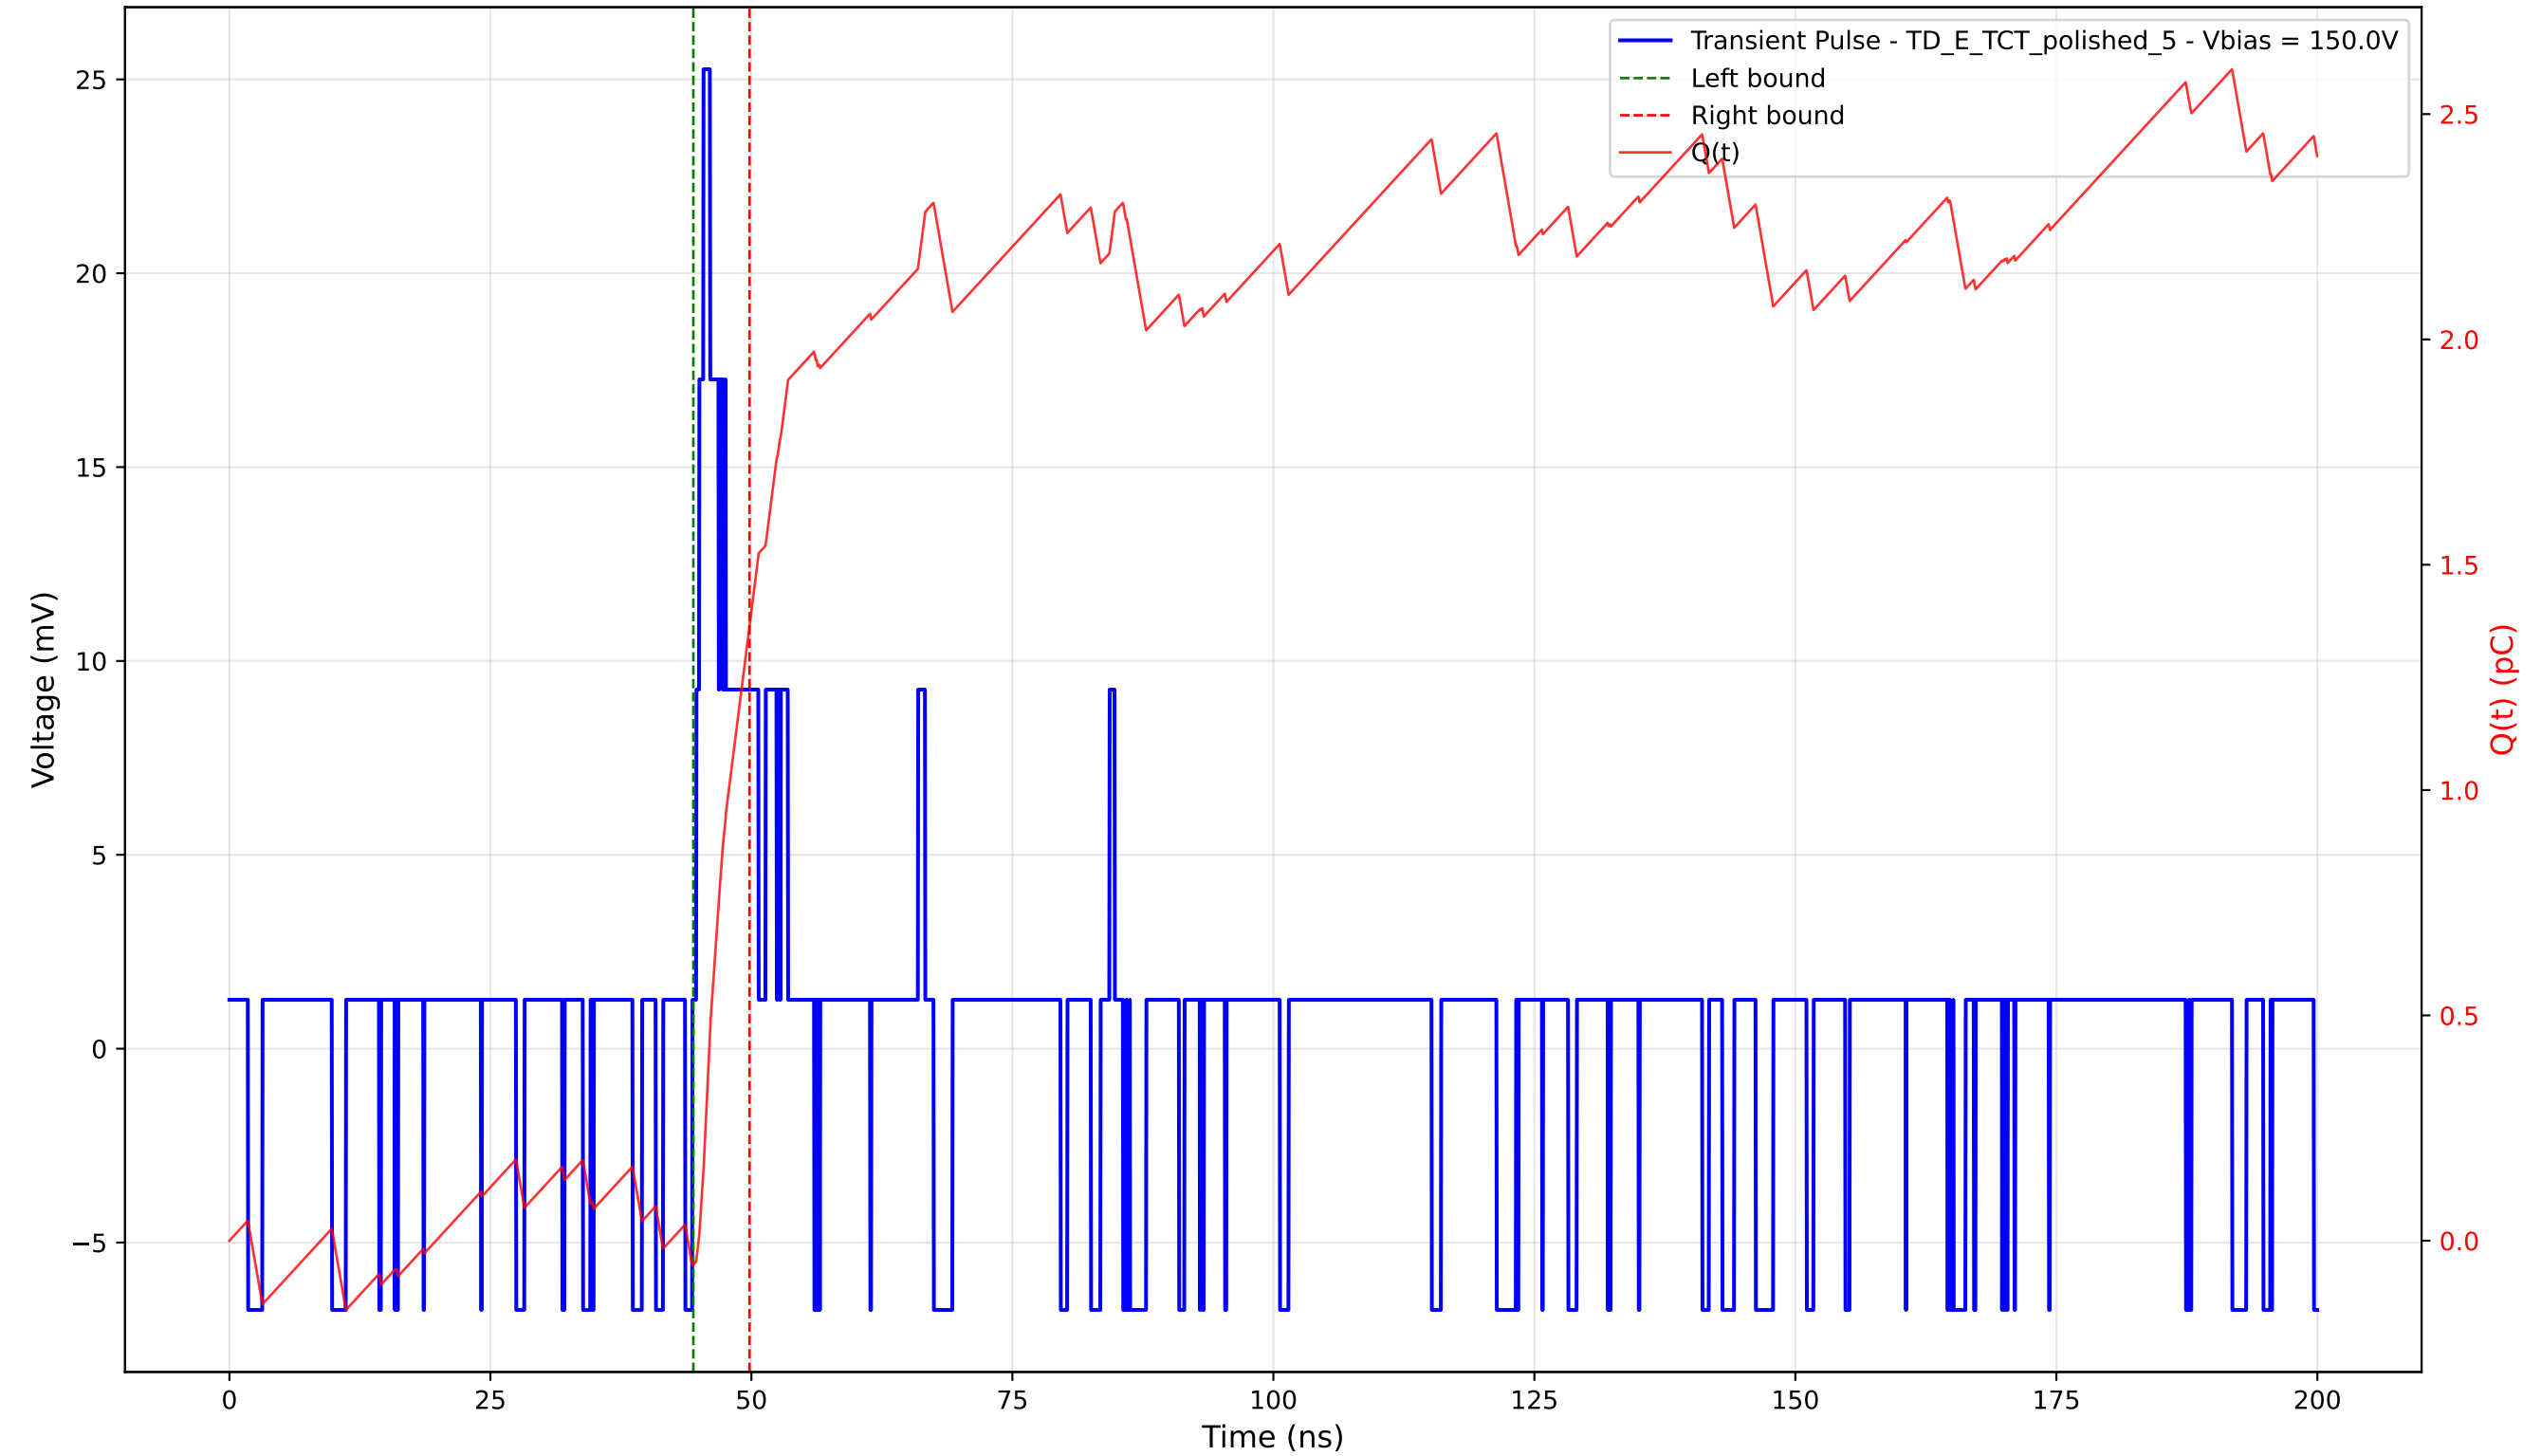


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 2.29 pC - Rise Time: 0.78 ns

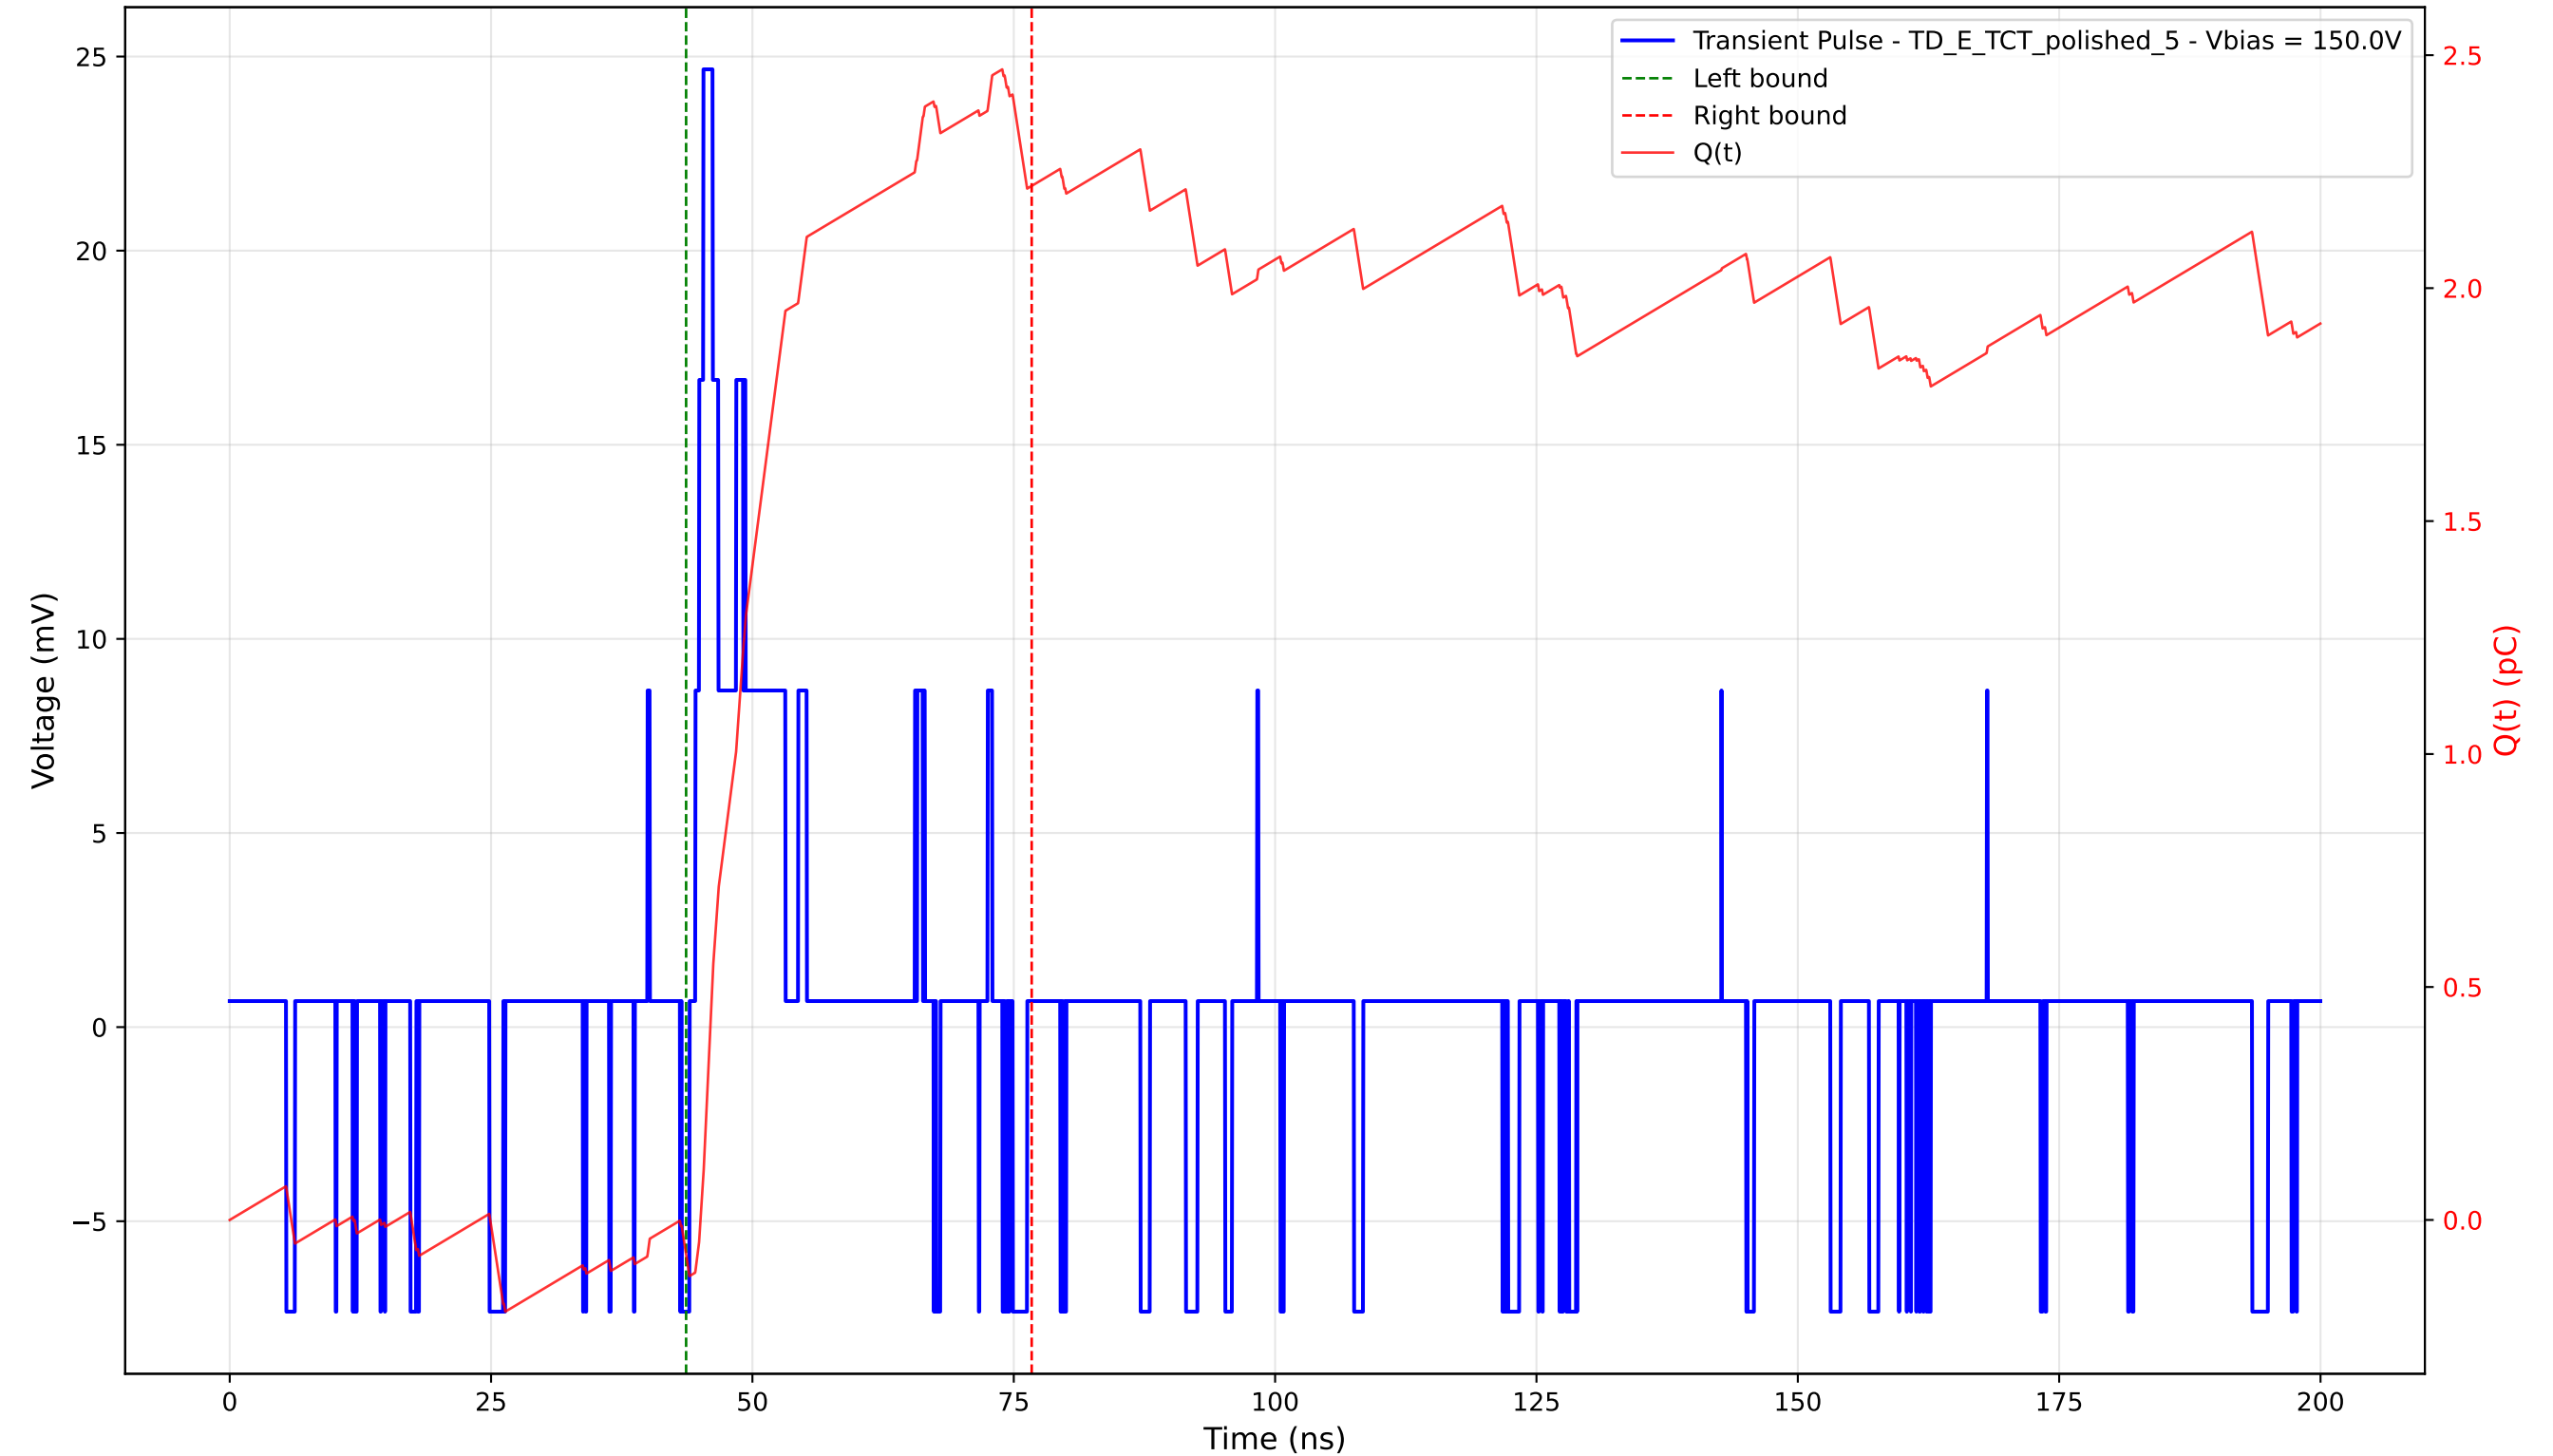


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.59 pC - Rise Time: 0.68 ns

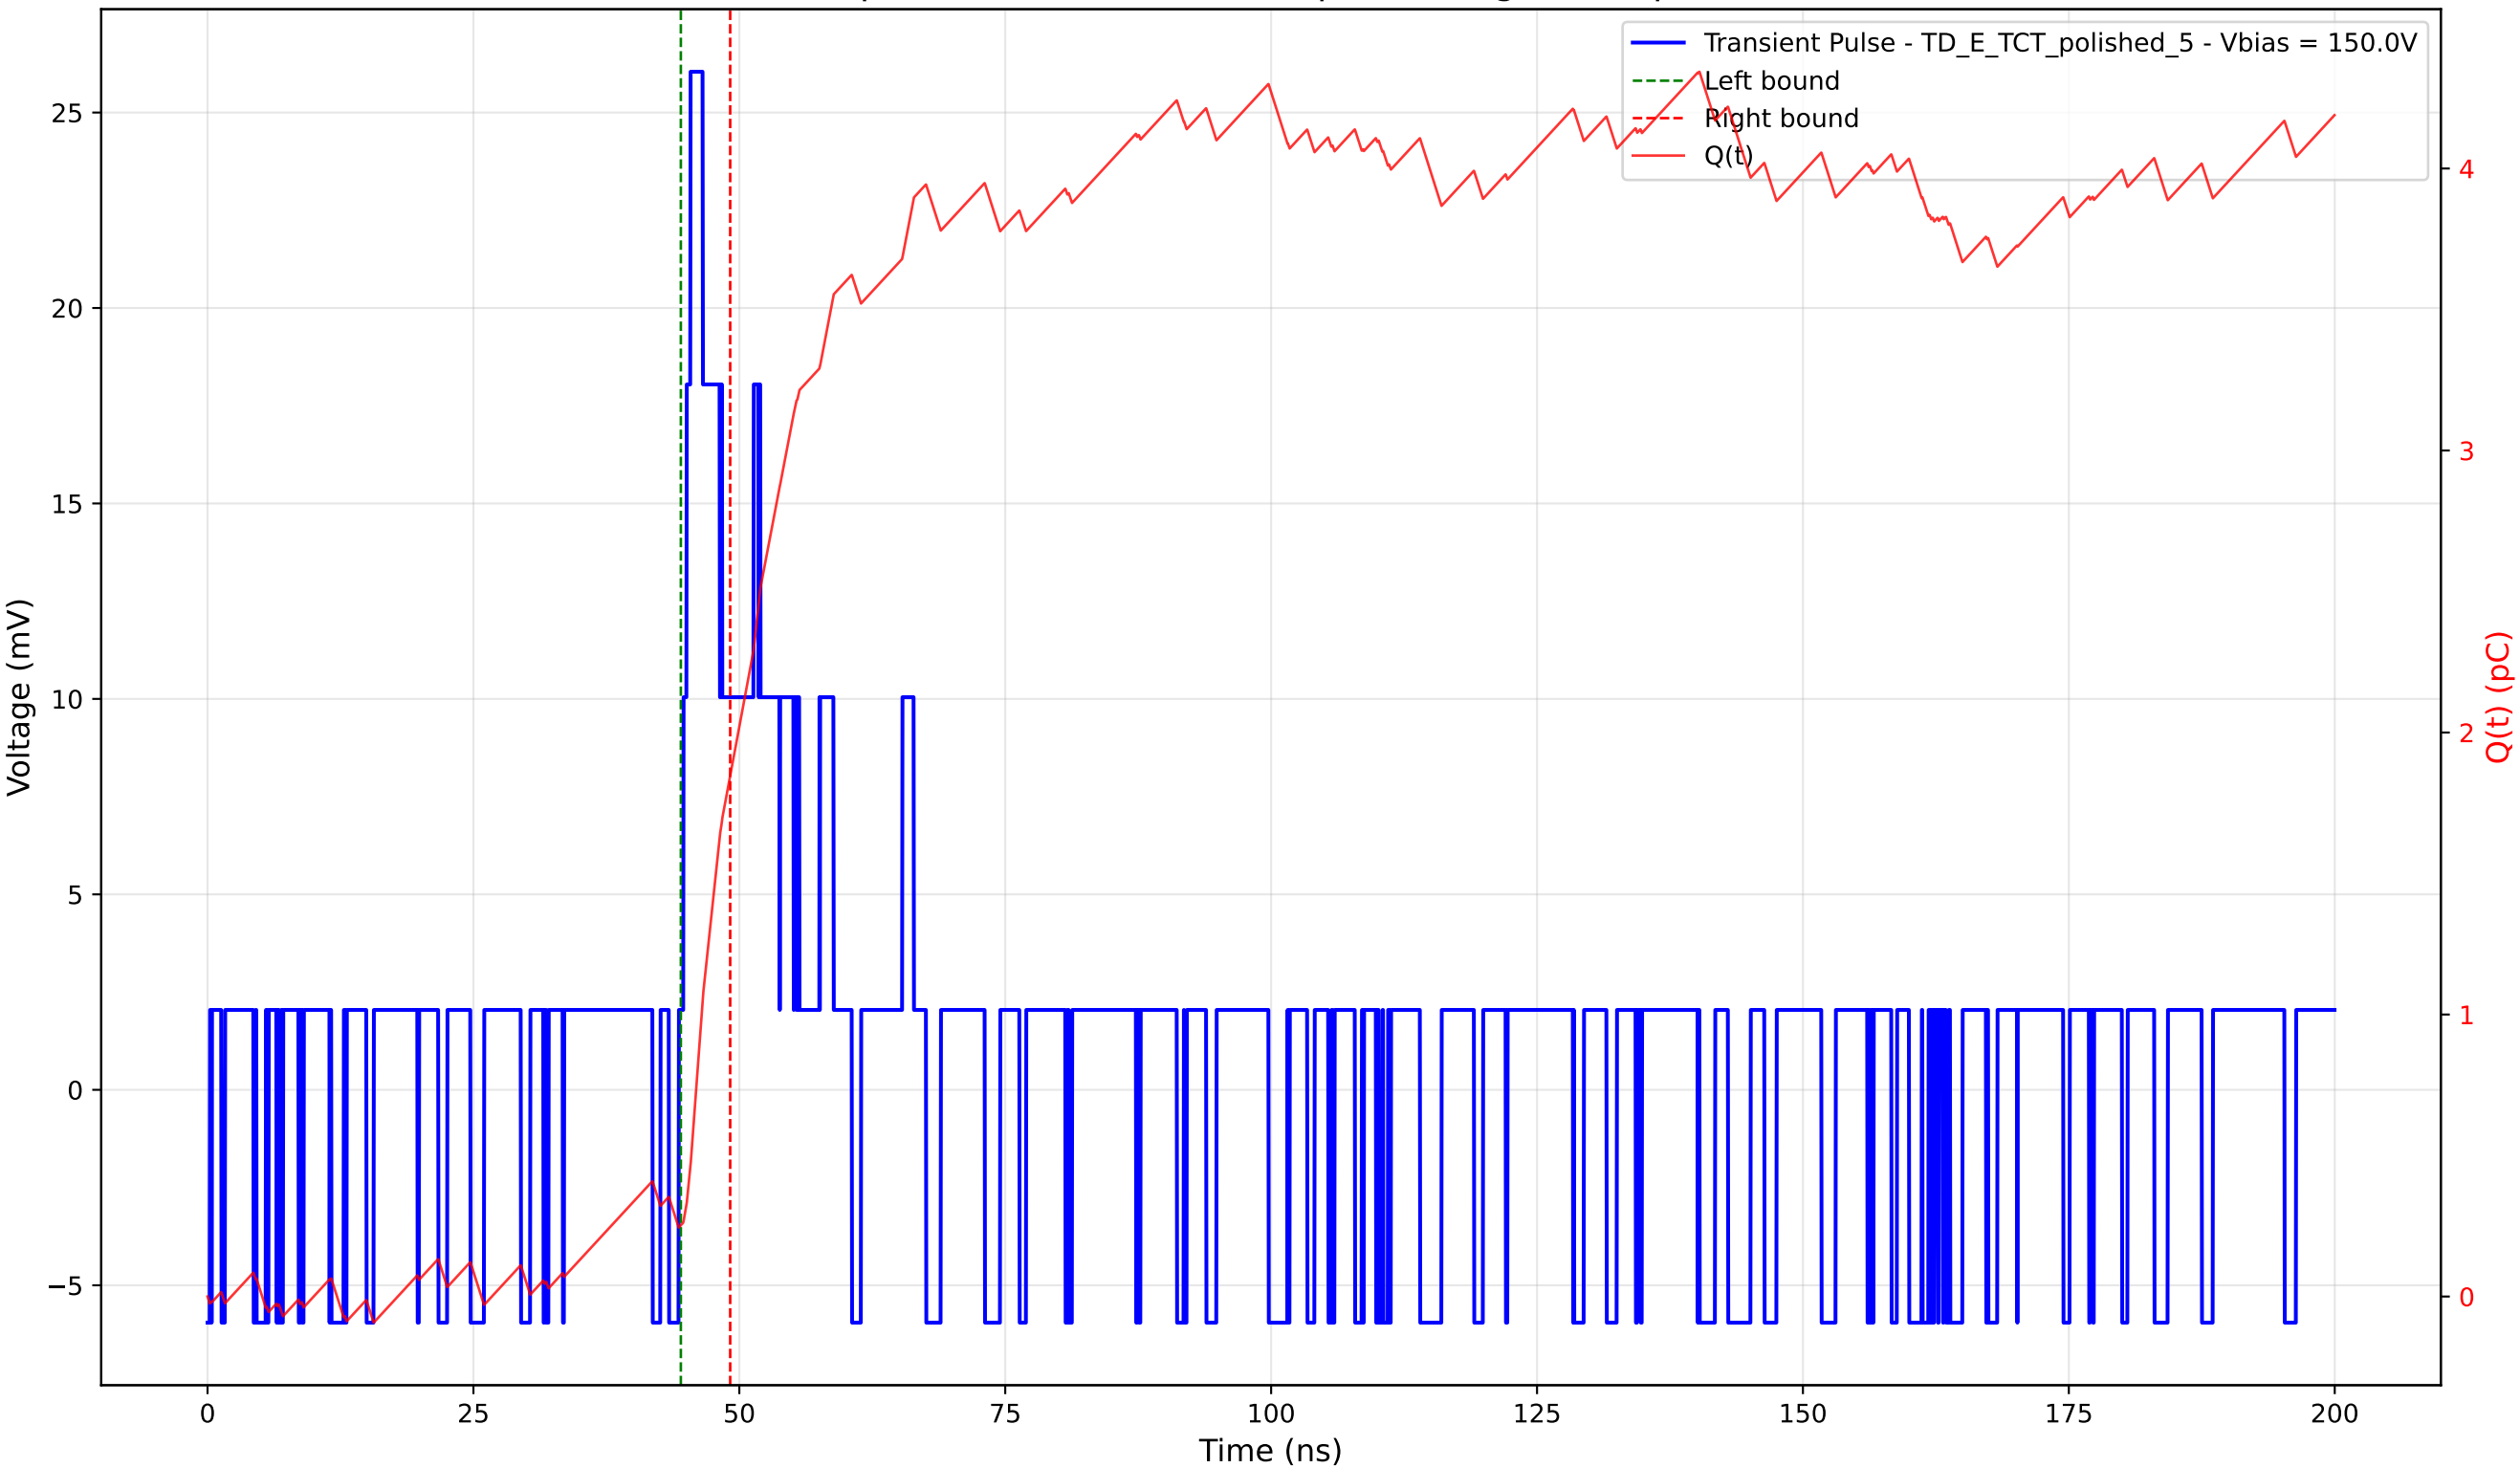


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 3.68 pC - Rise Time: 0.82 ns

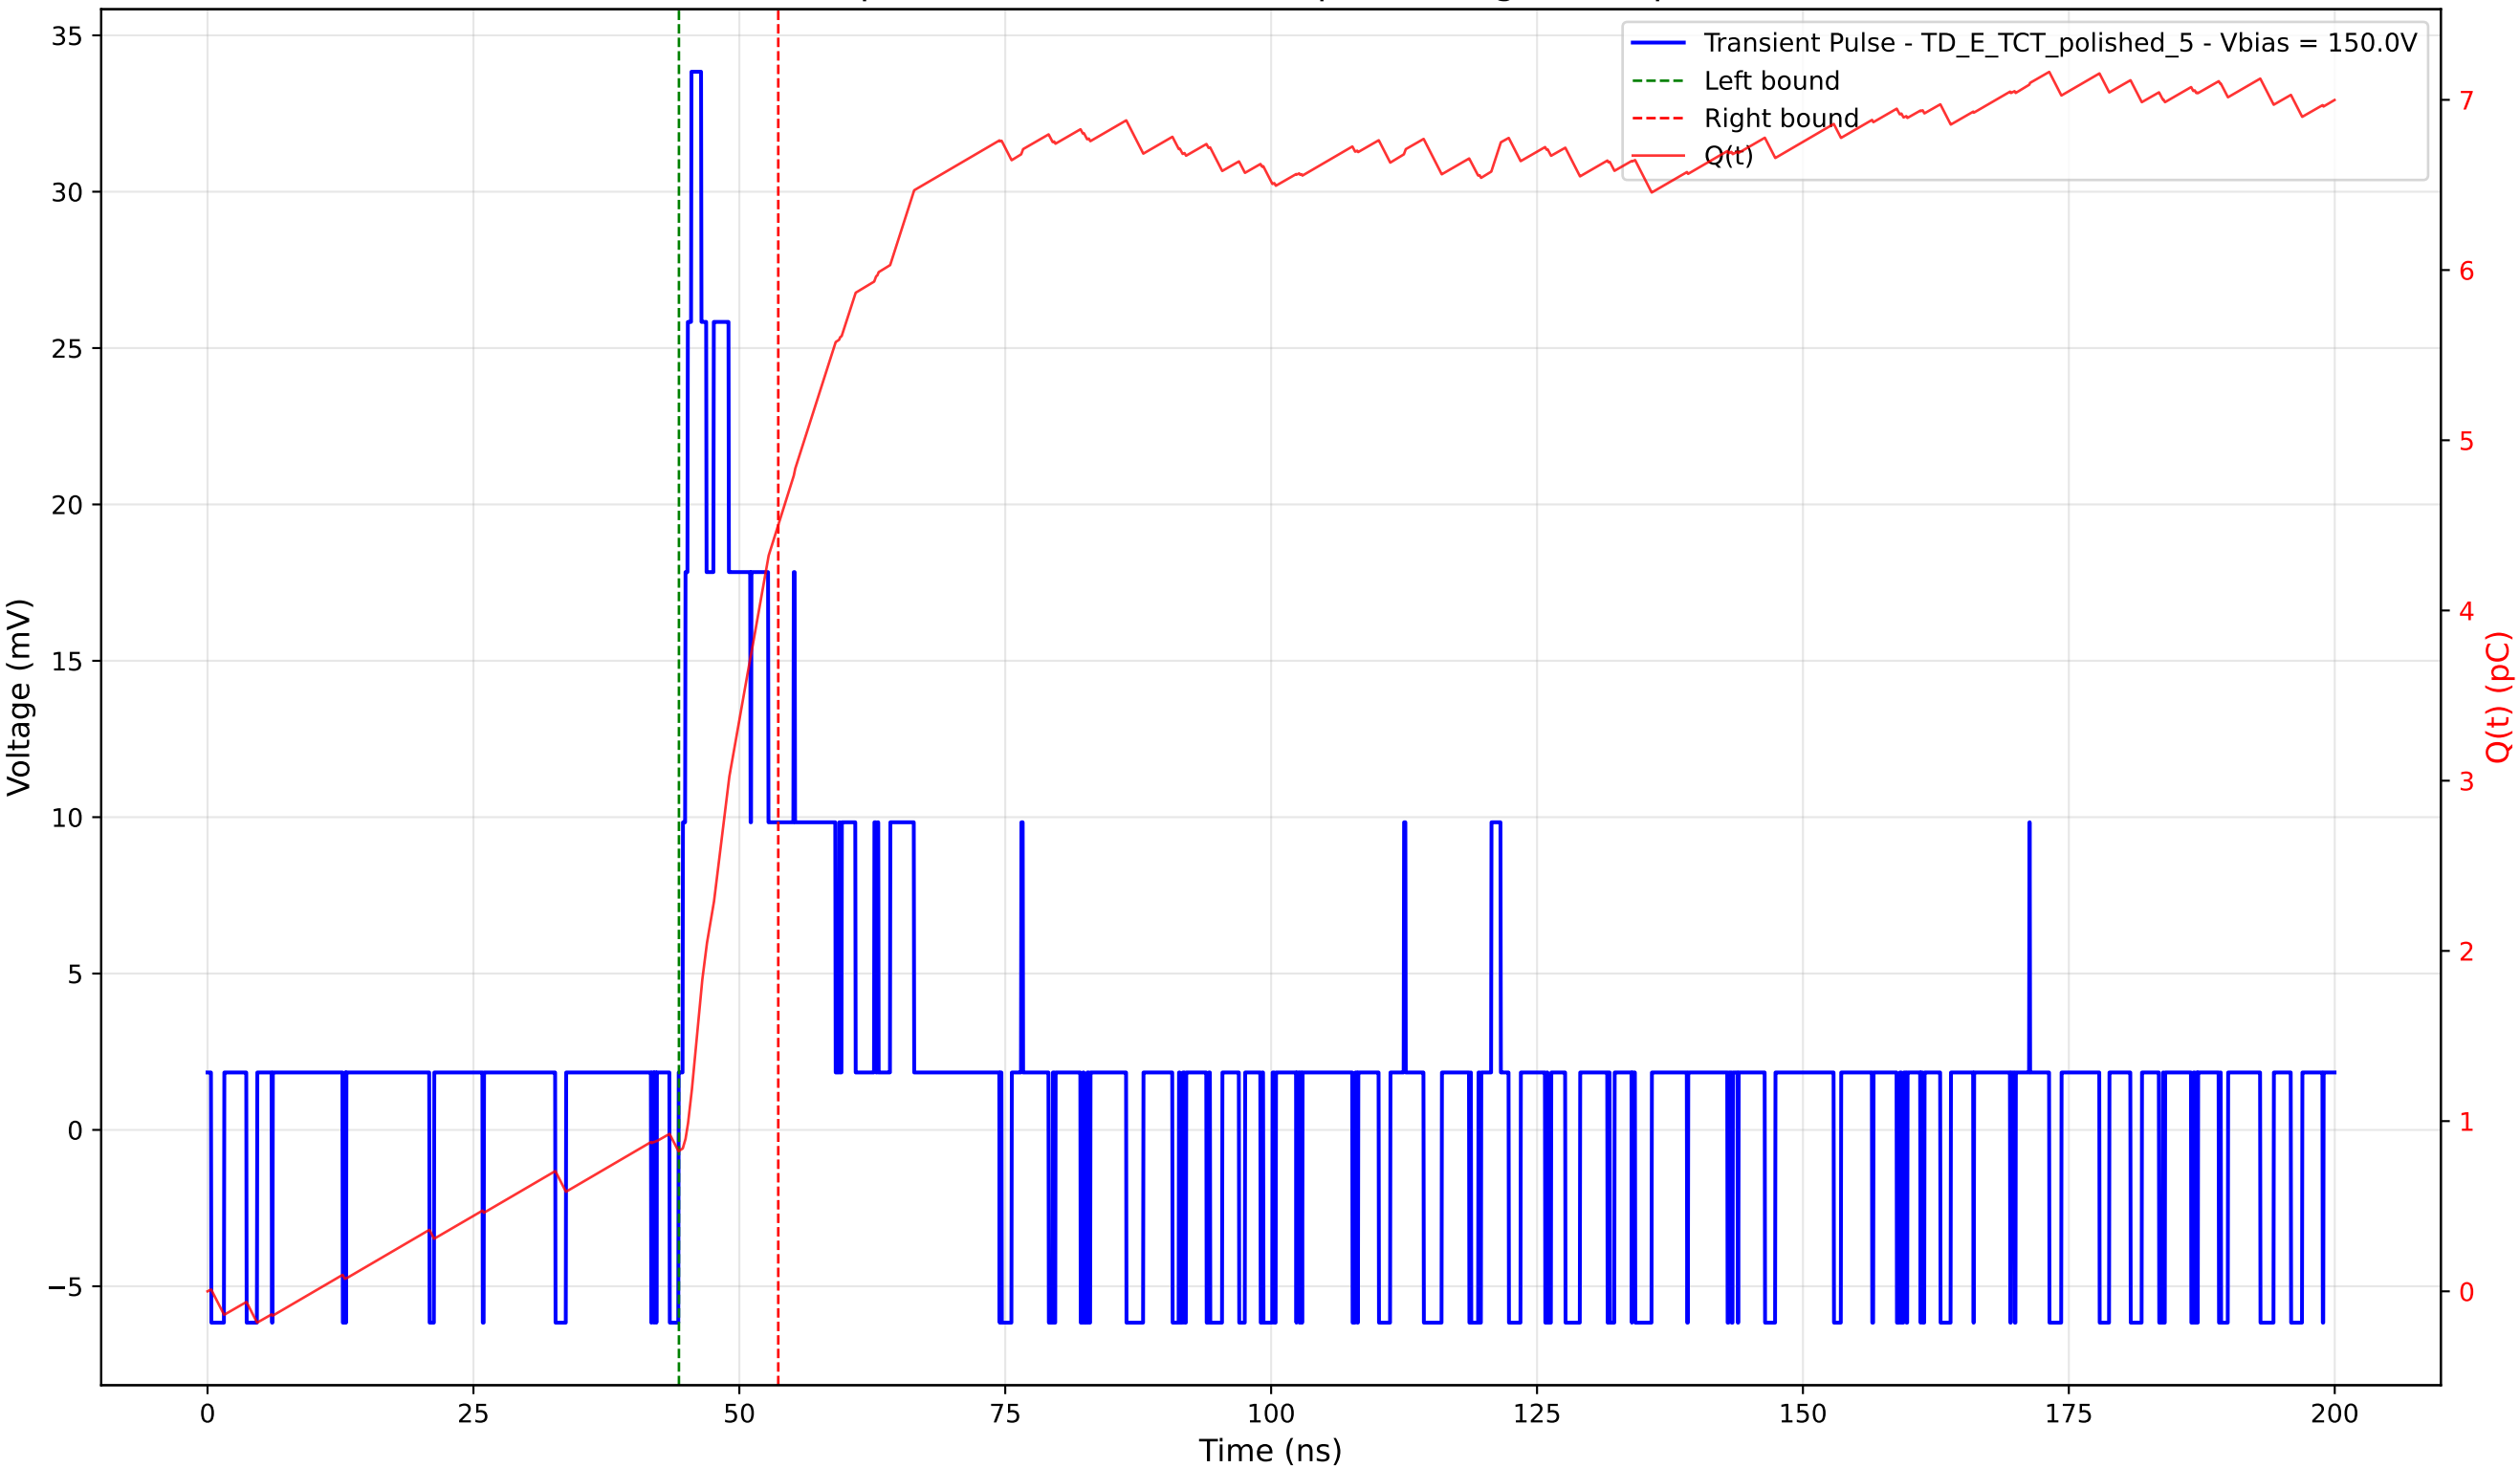


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 7.10 pC - Rise Time: 1.15 ns

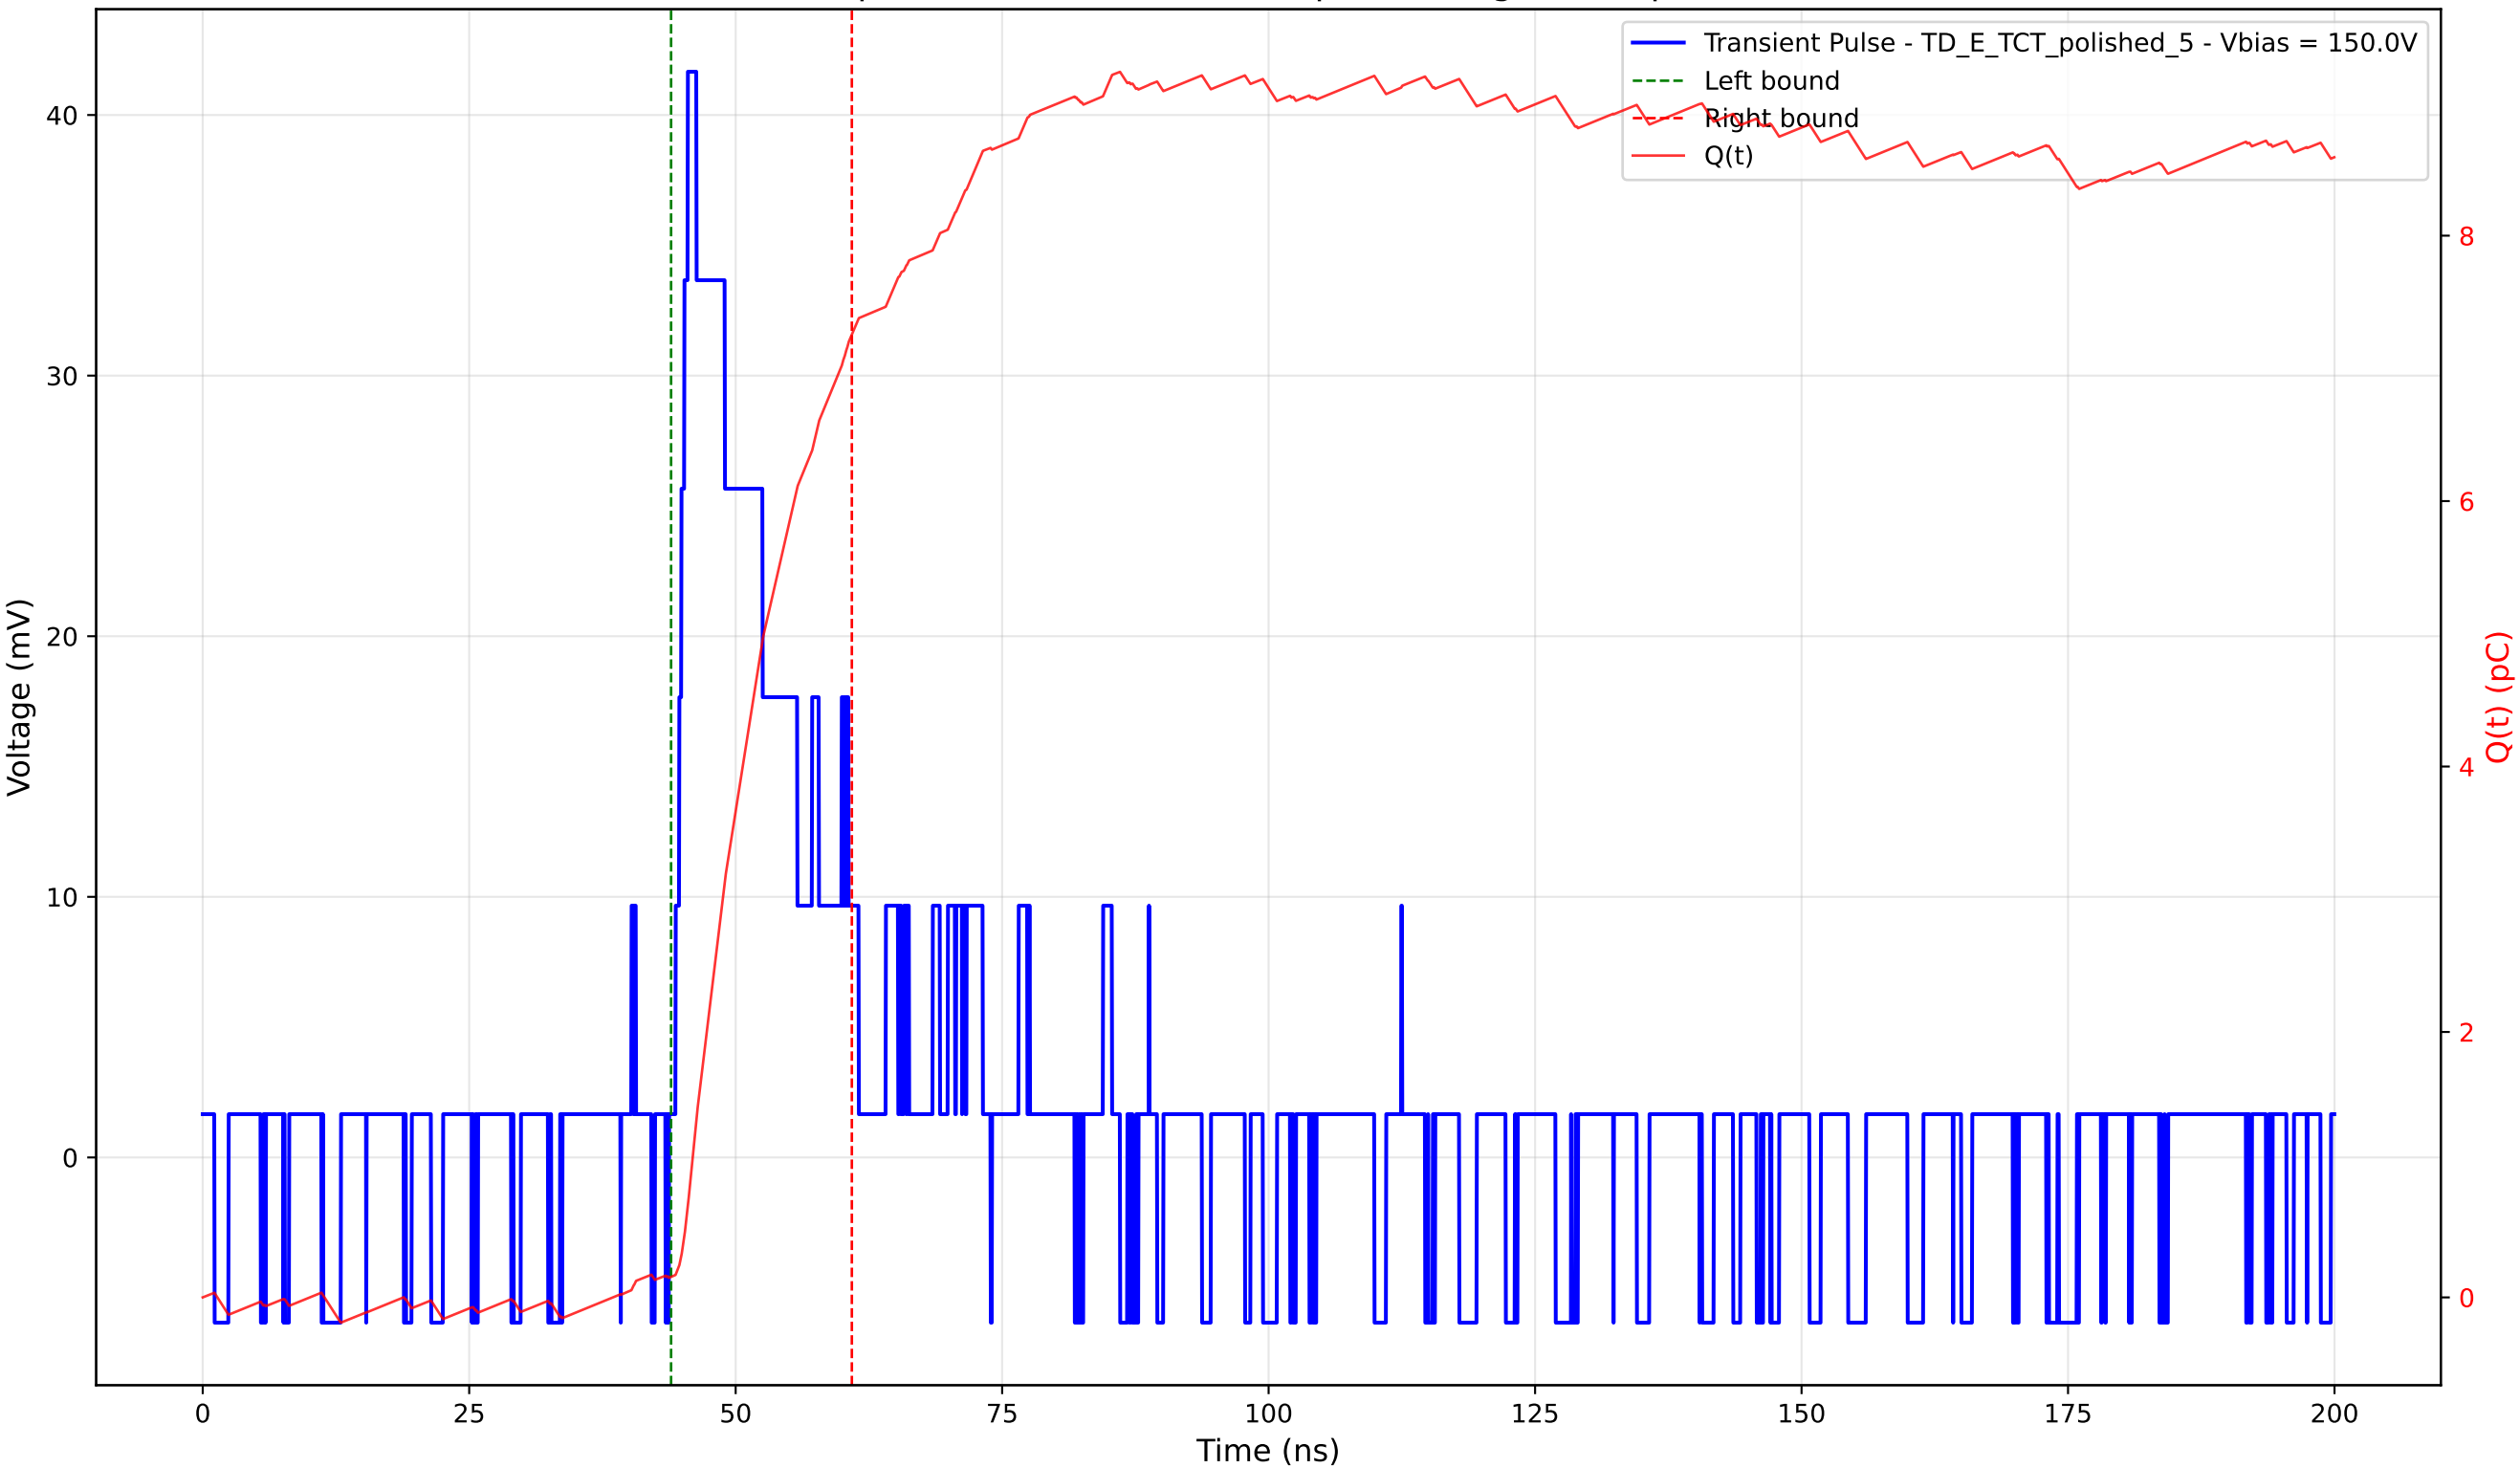


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 7.36 pC - Rise Time: 1.06 ns

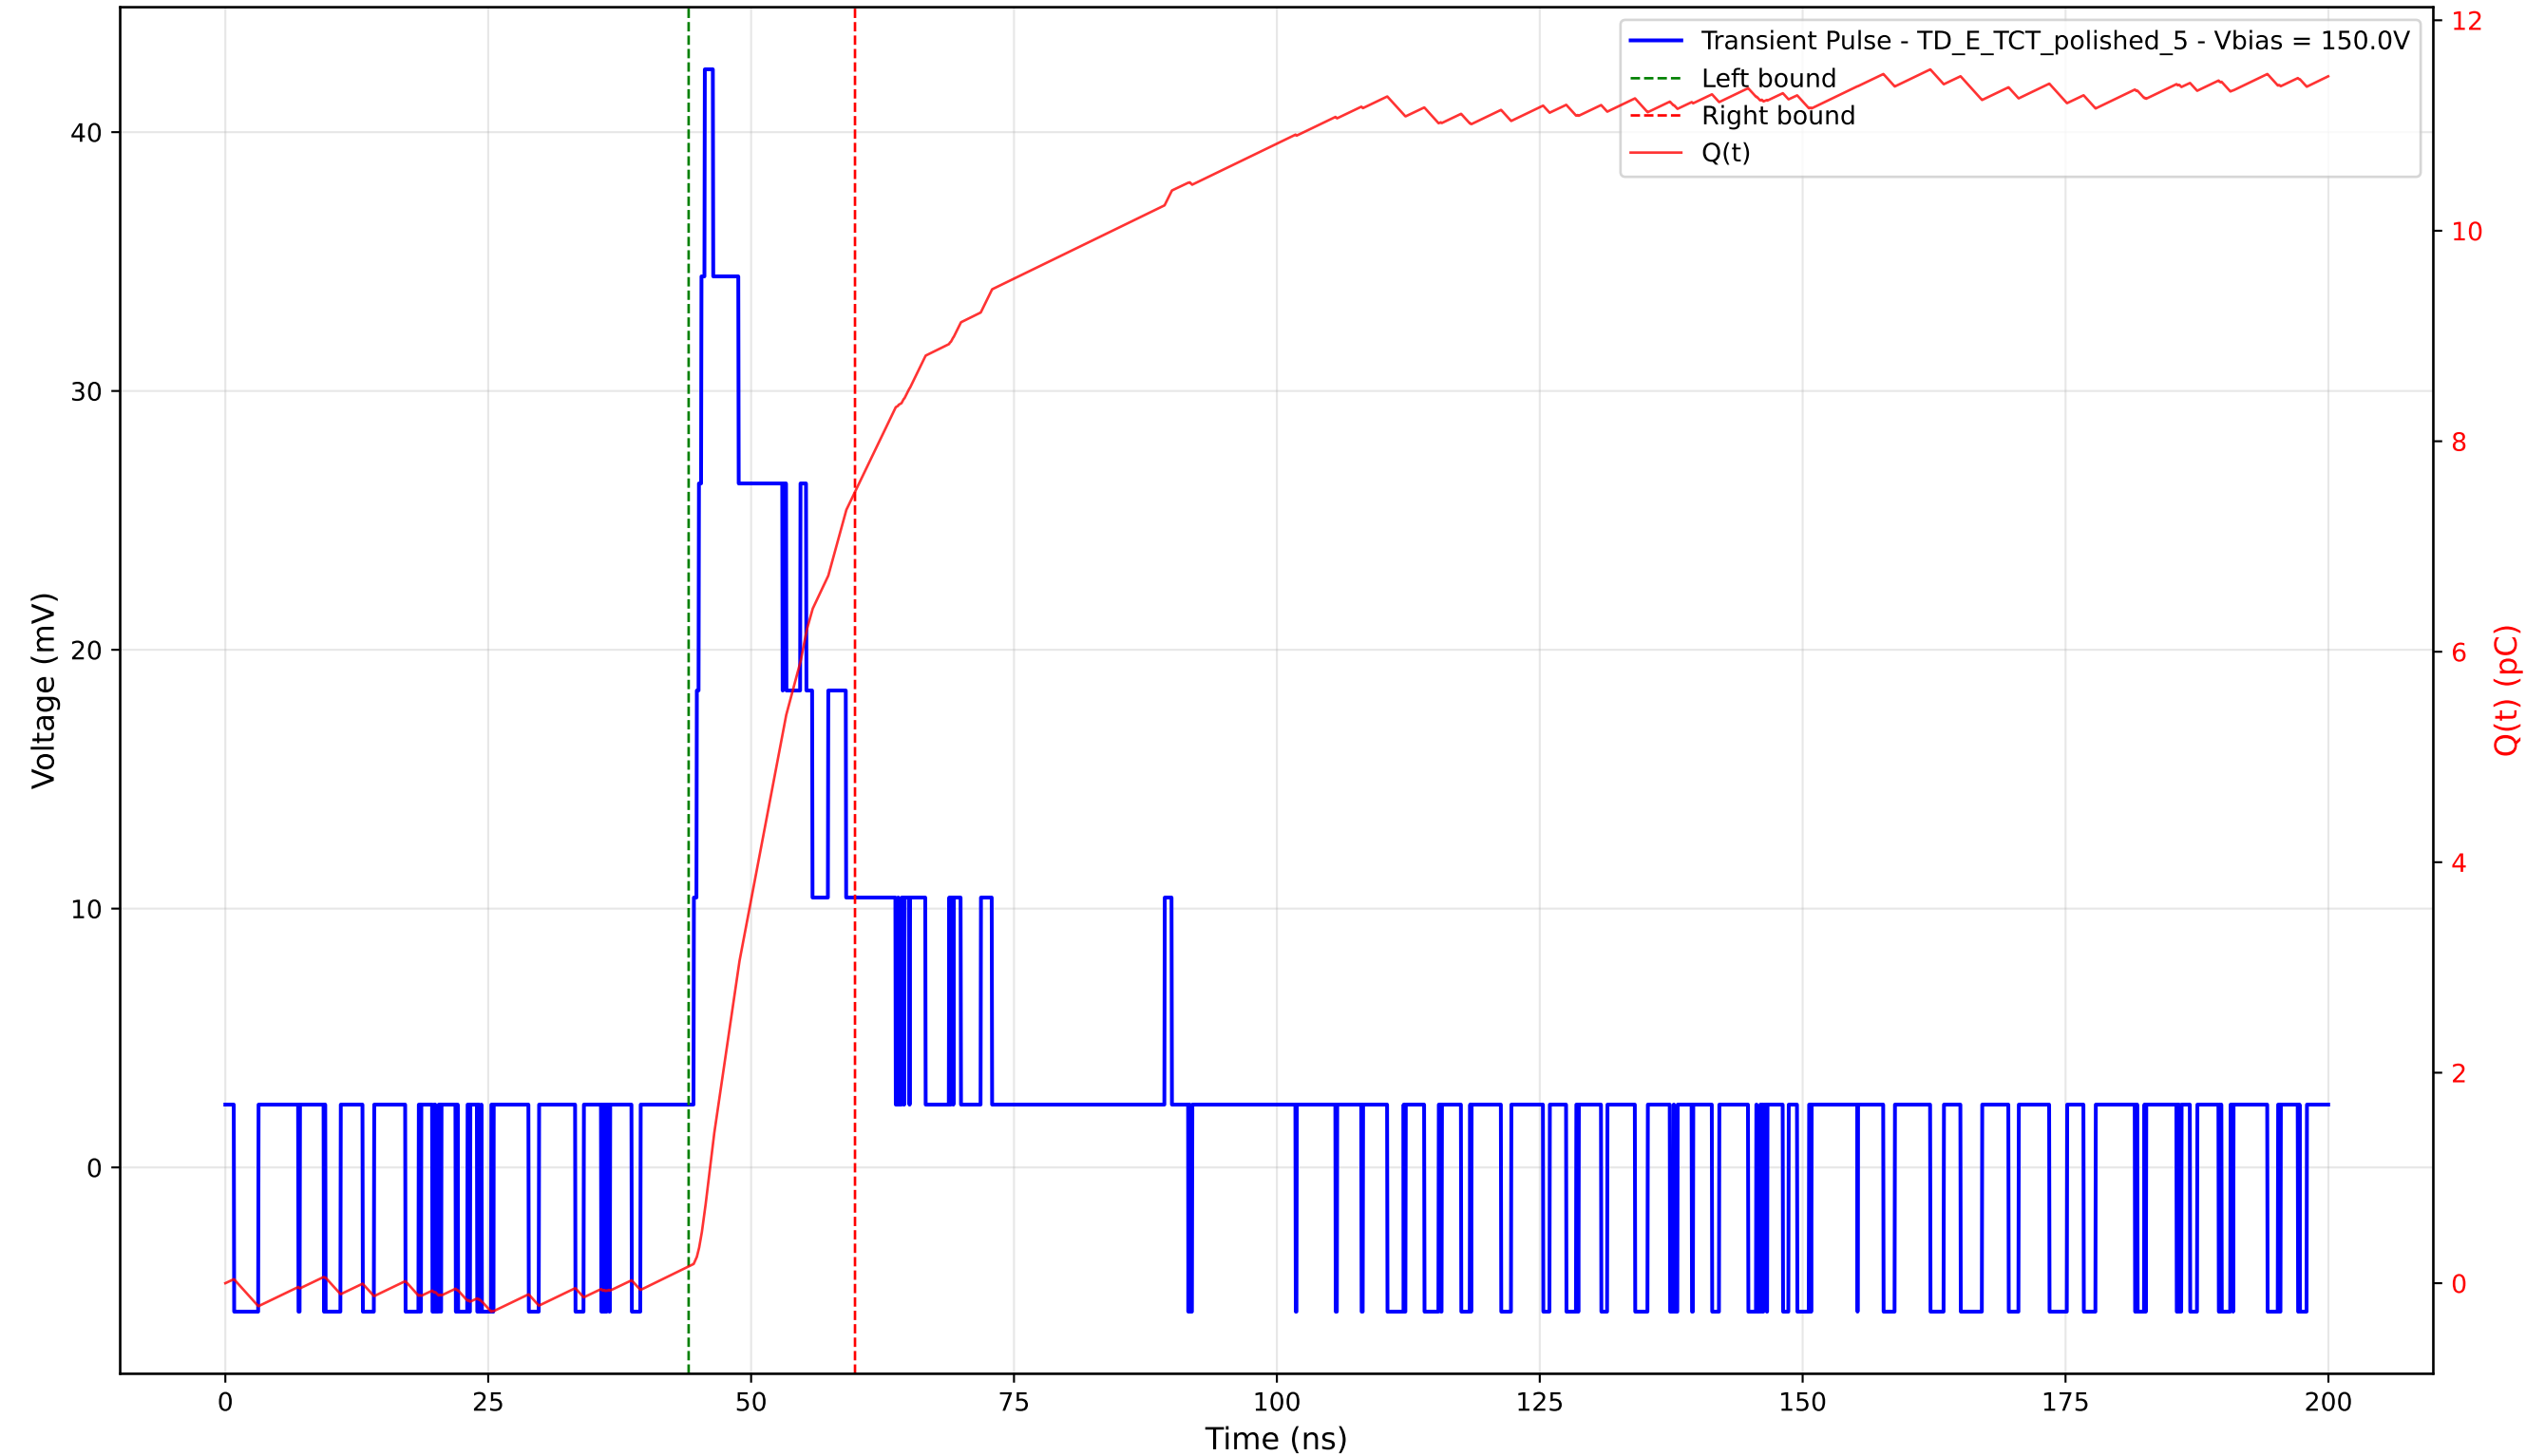


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 4.96 pC - Rise Time: 0.91 ns

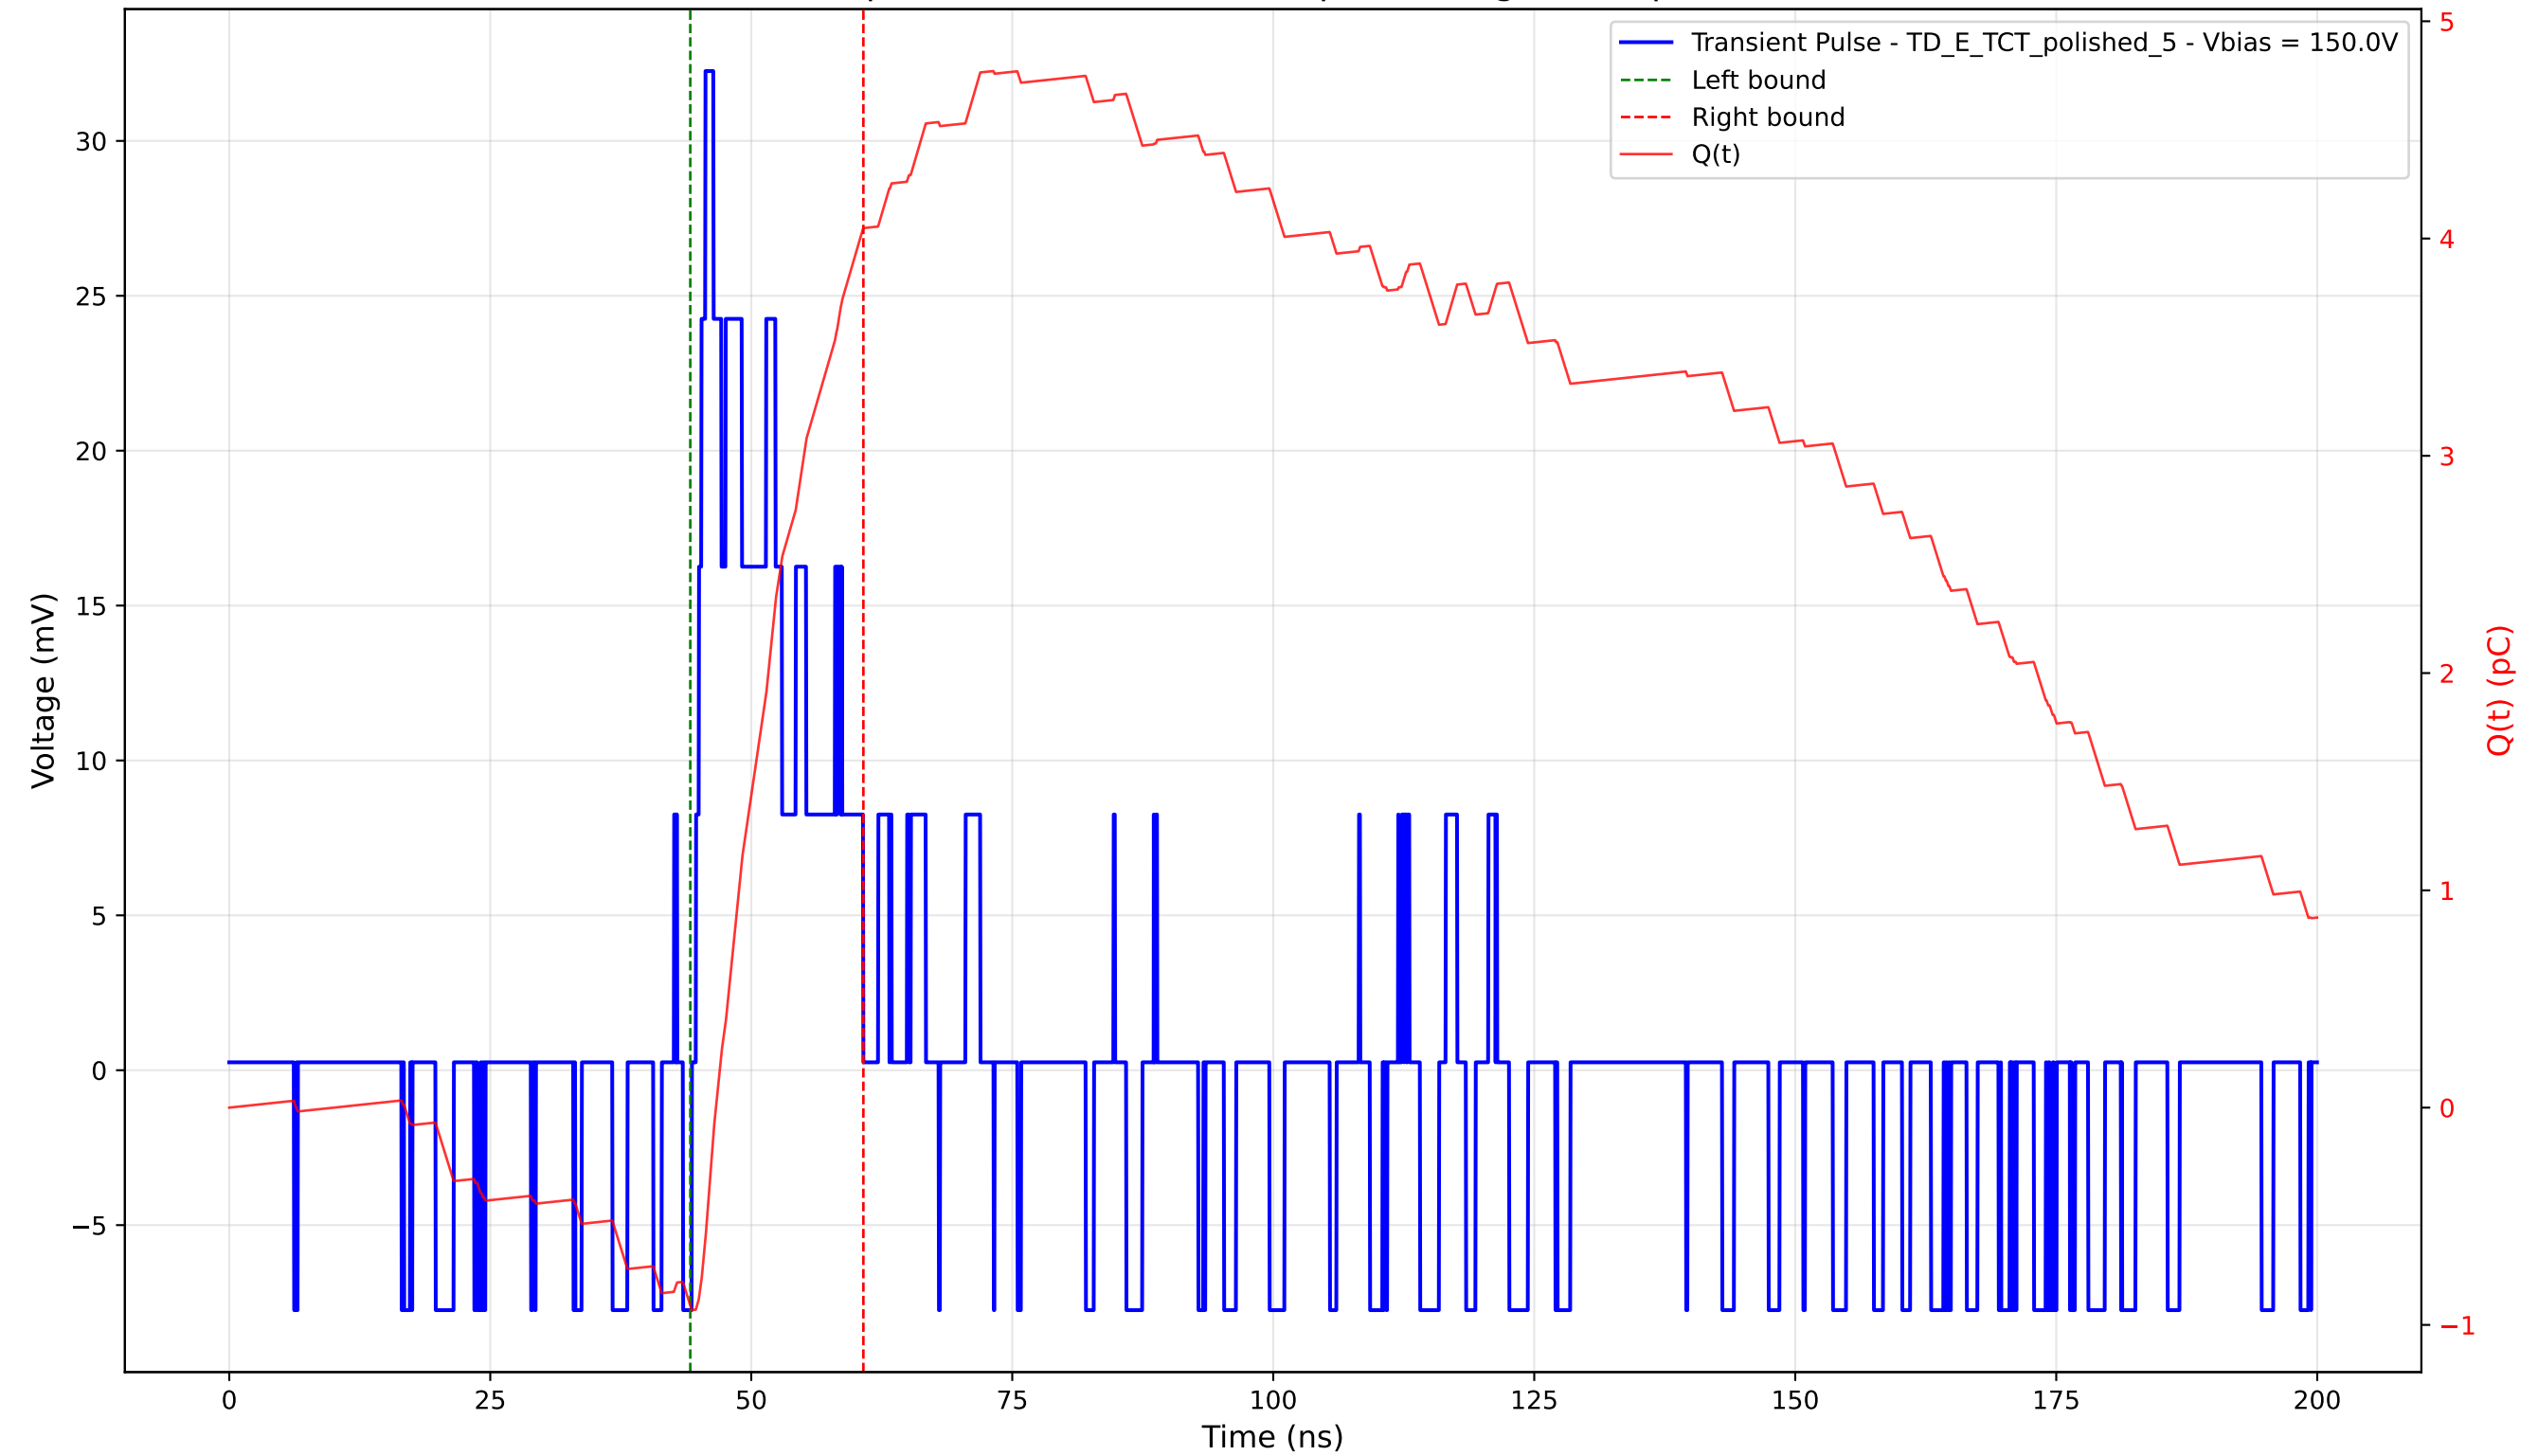


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 2.15 pC - Rise Time: 0.44 ns

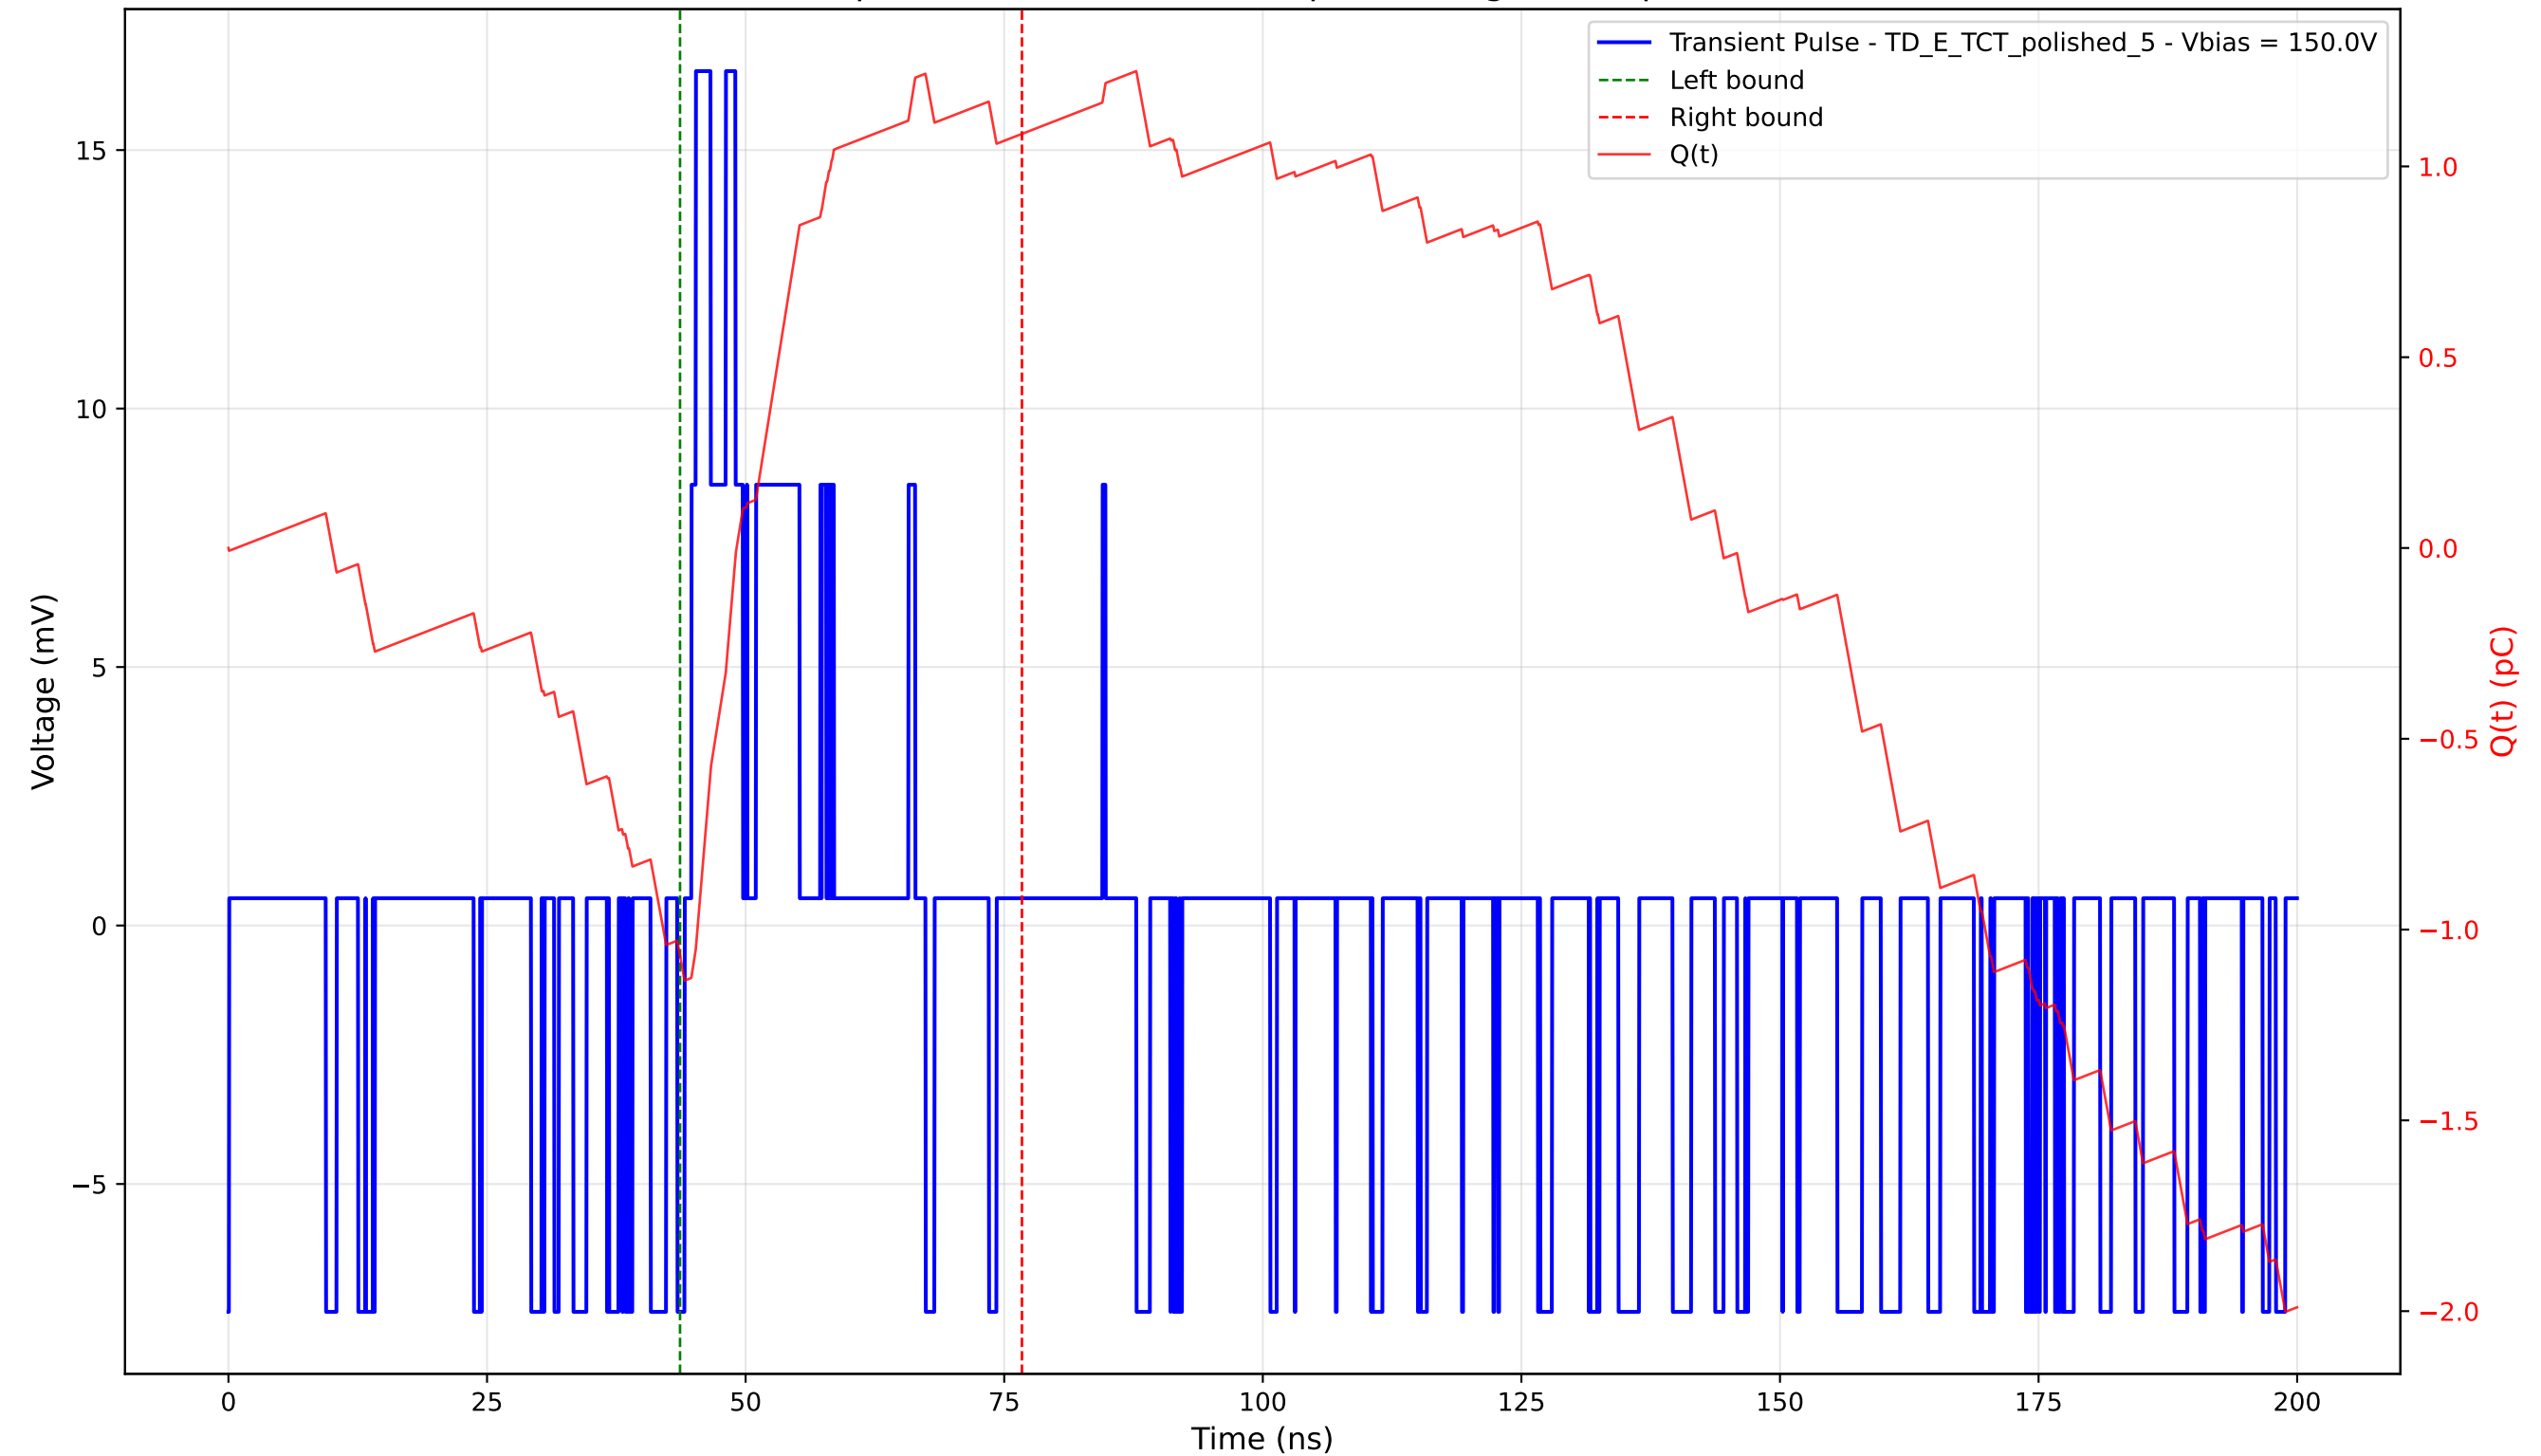


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 1.71 pC - Rise Time: 0.00 ns (N/A)

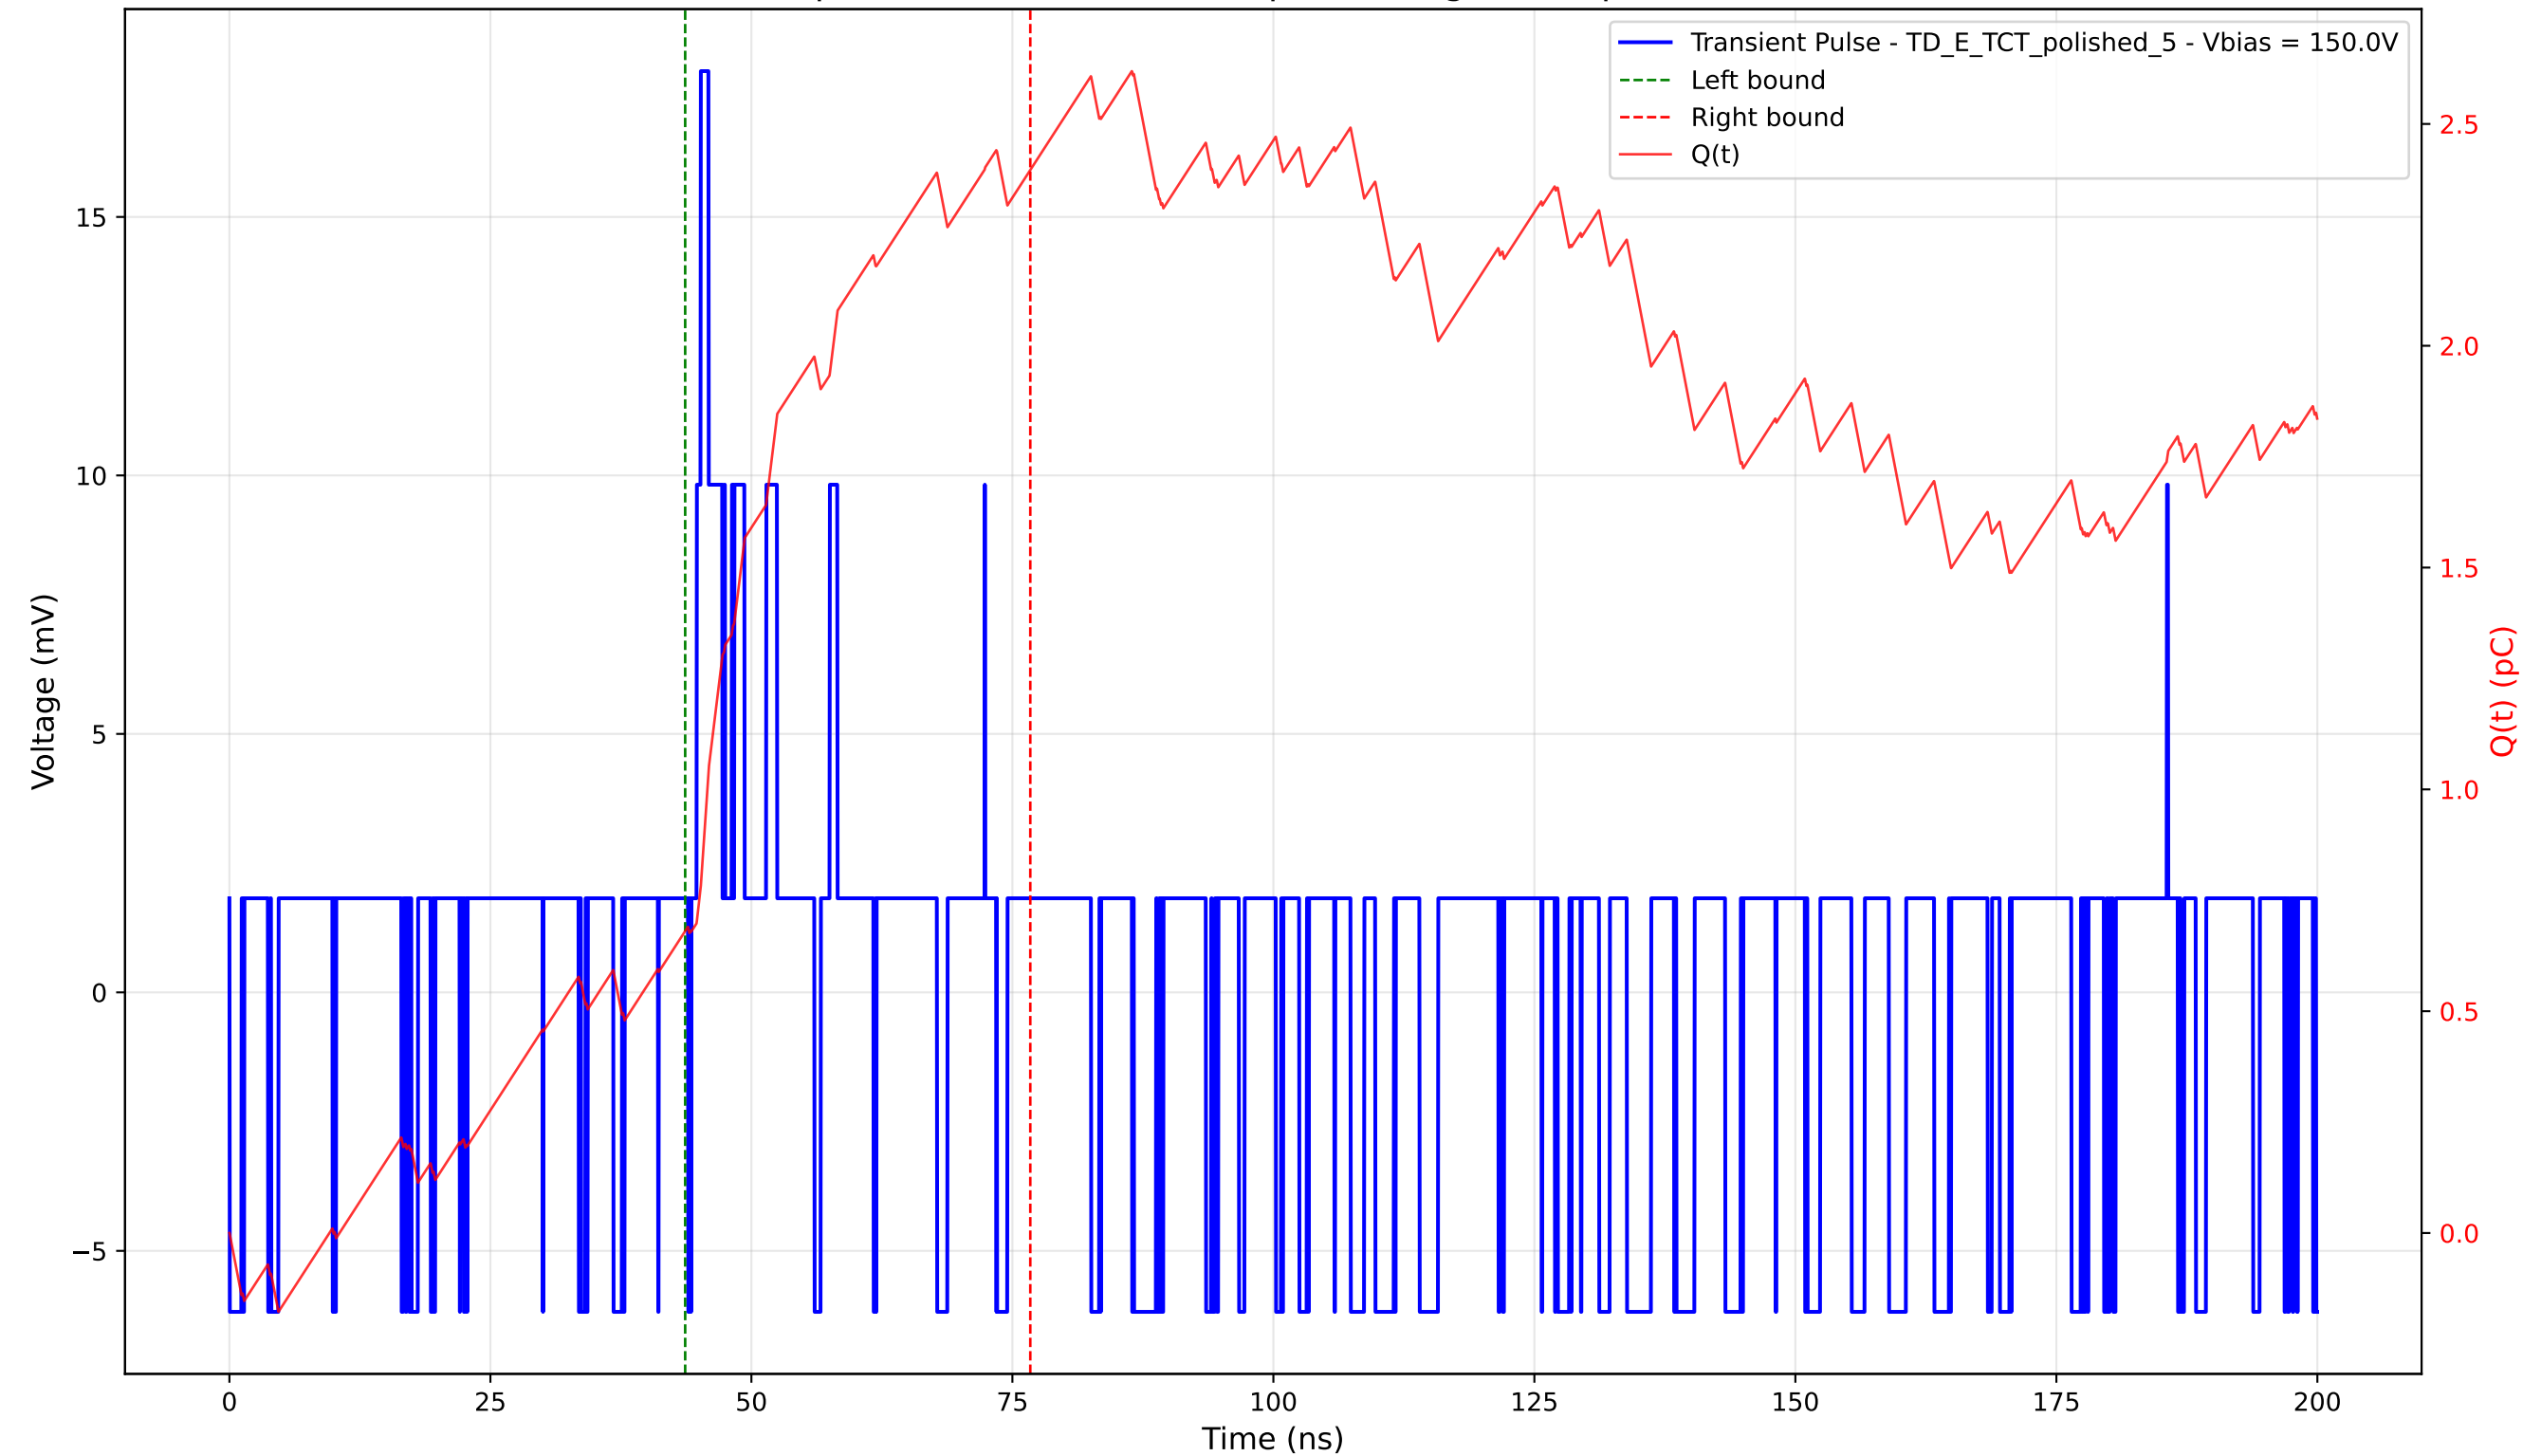


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 1.06 pC - Rise Time: 0.34 ns

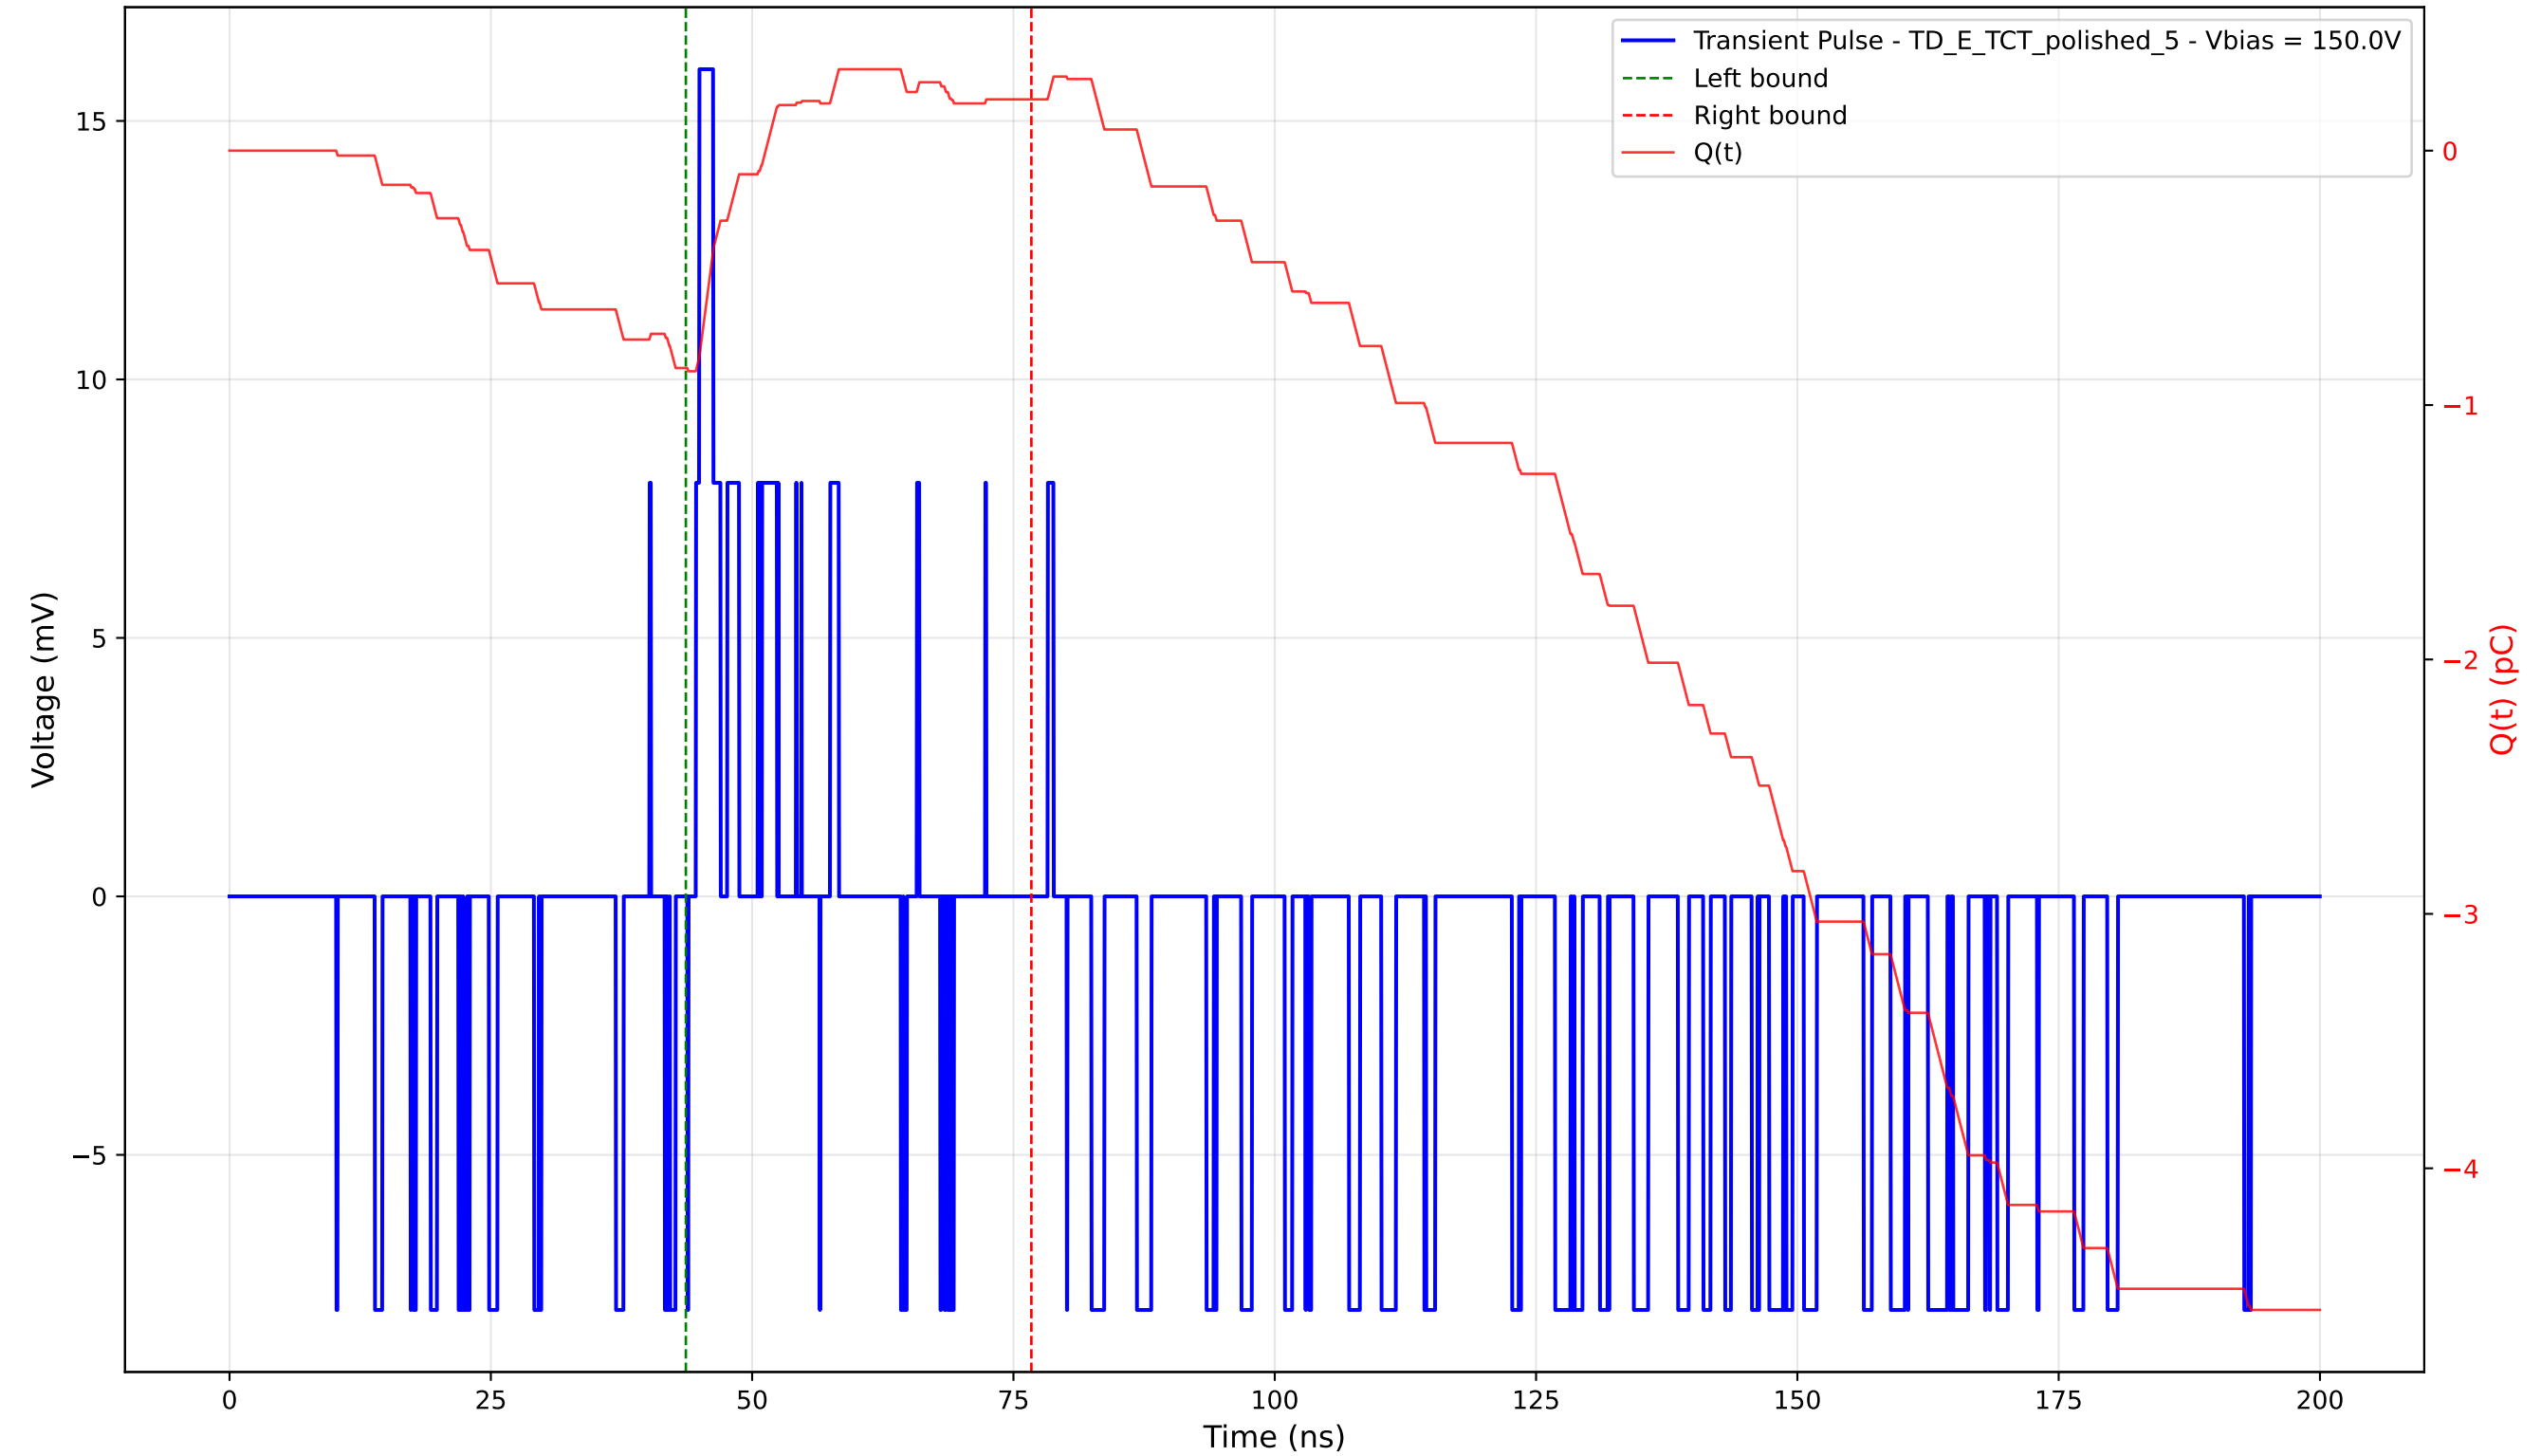


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.68 pC - Rise Time: 0.95 ns

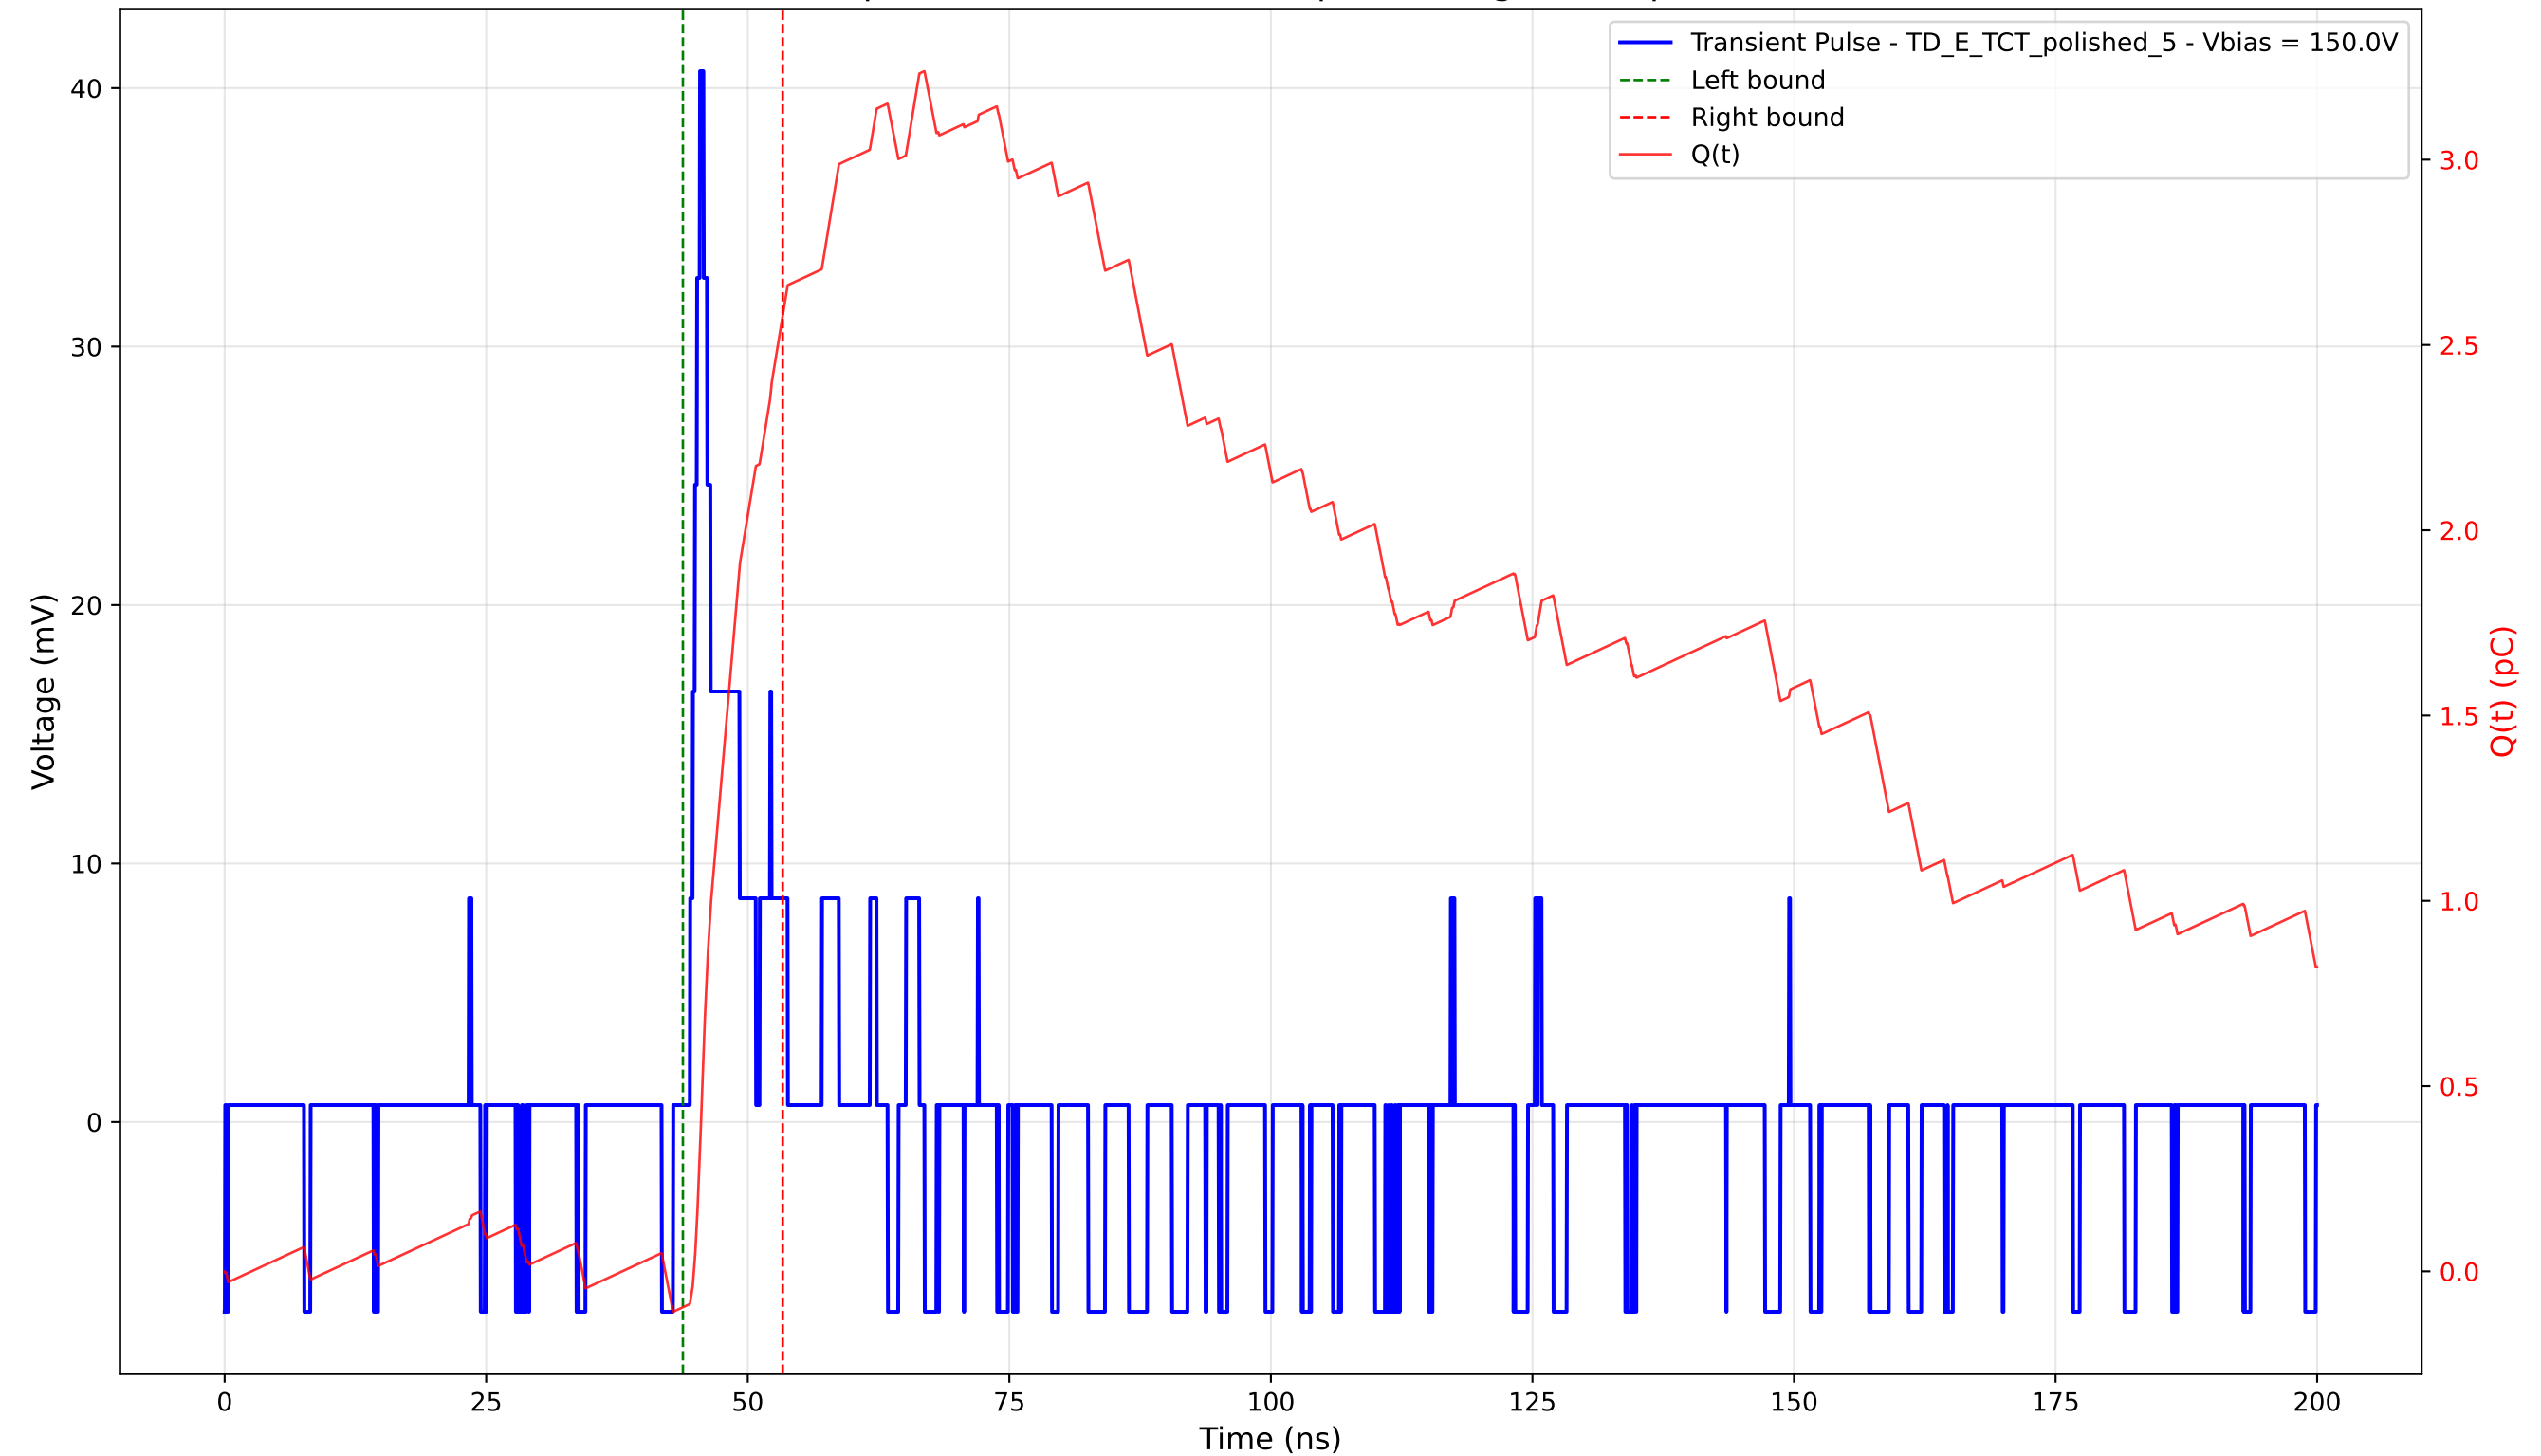


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 6.63 pC - Rise Time: 0.99 ns

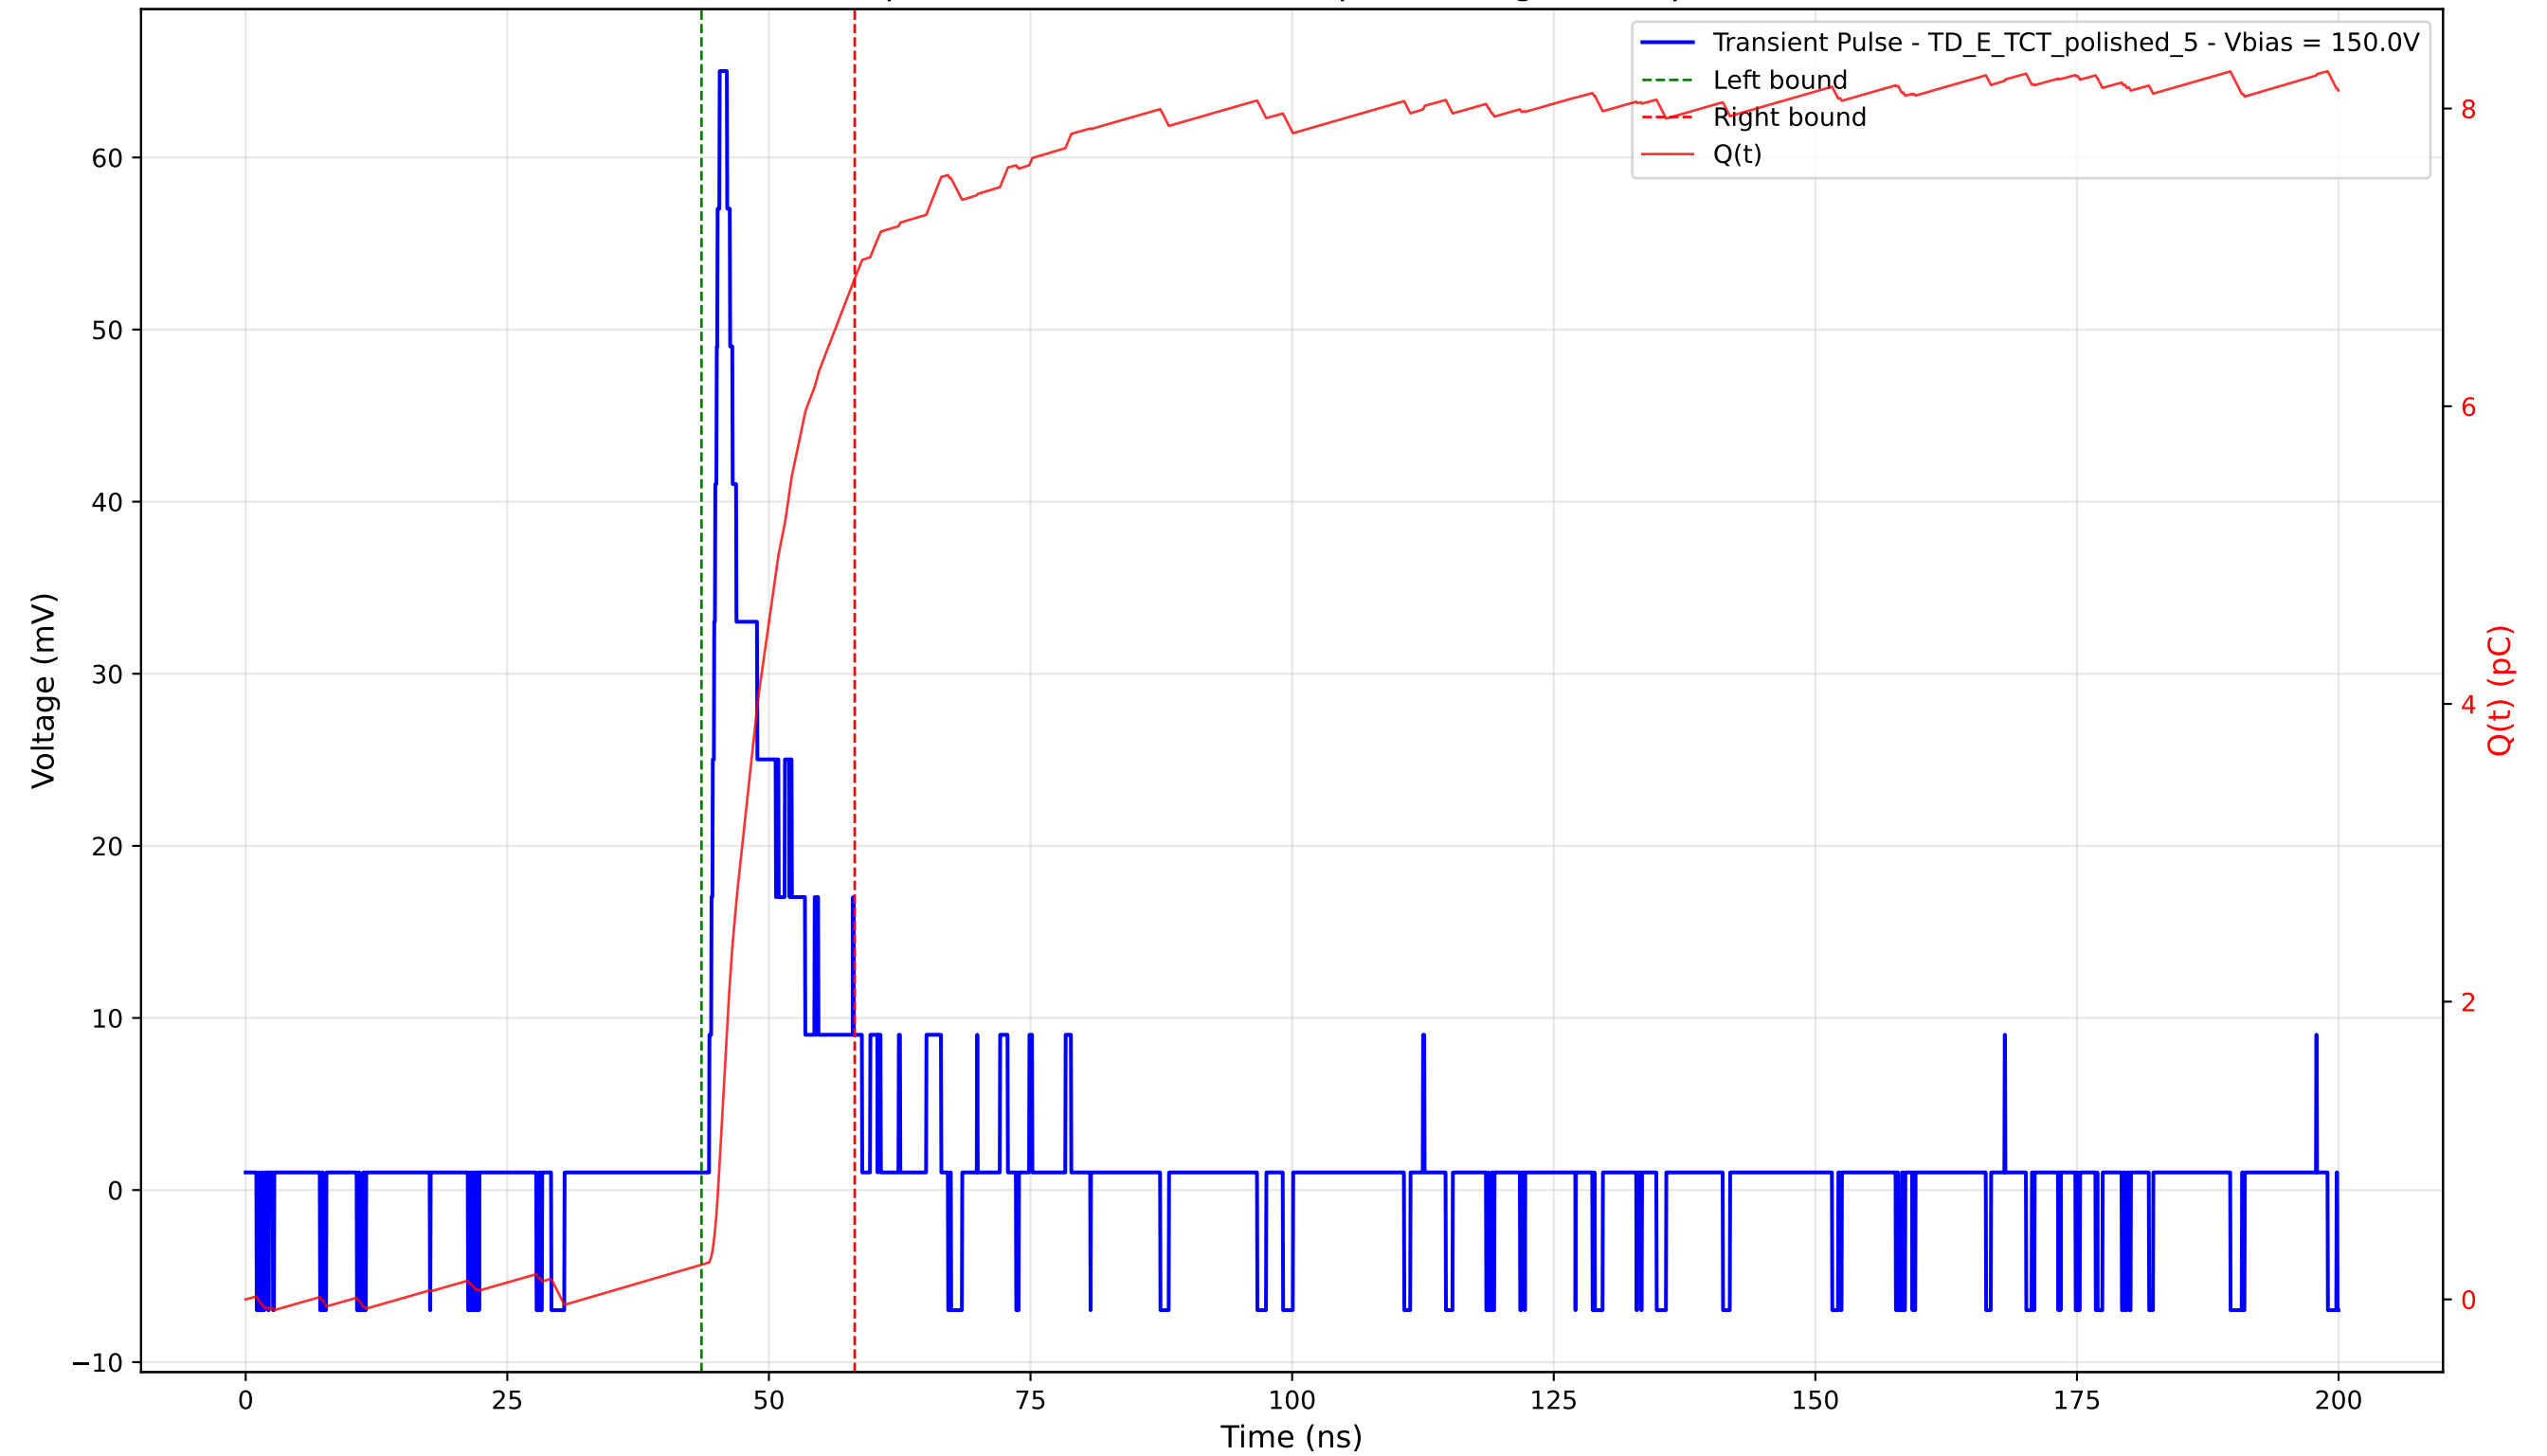


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 12.80 pC - Rise Time: 0.99 ns

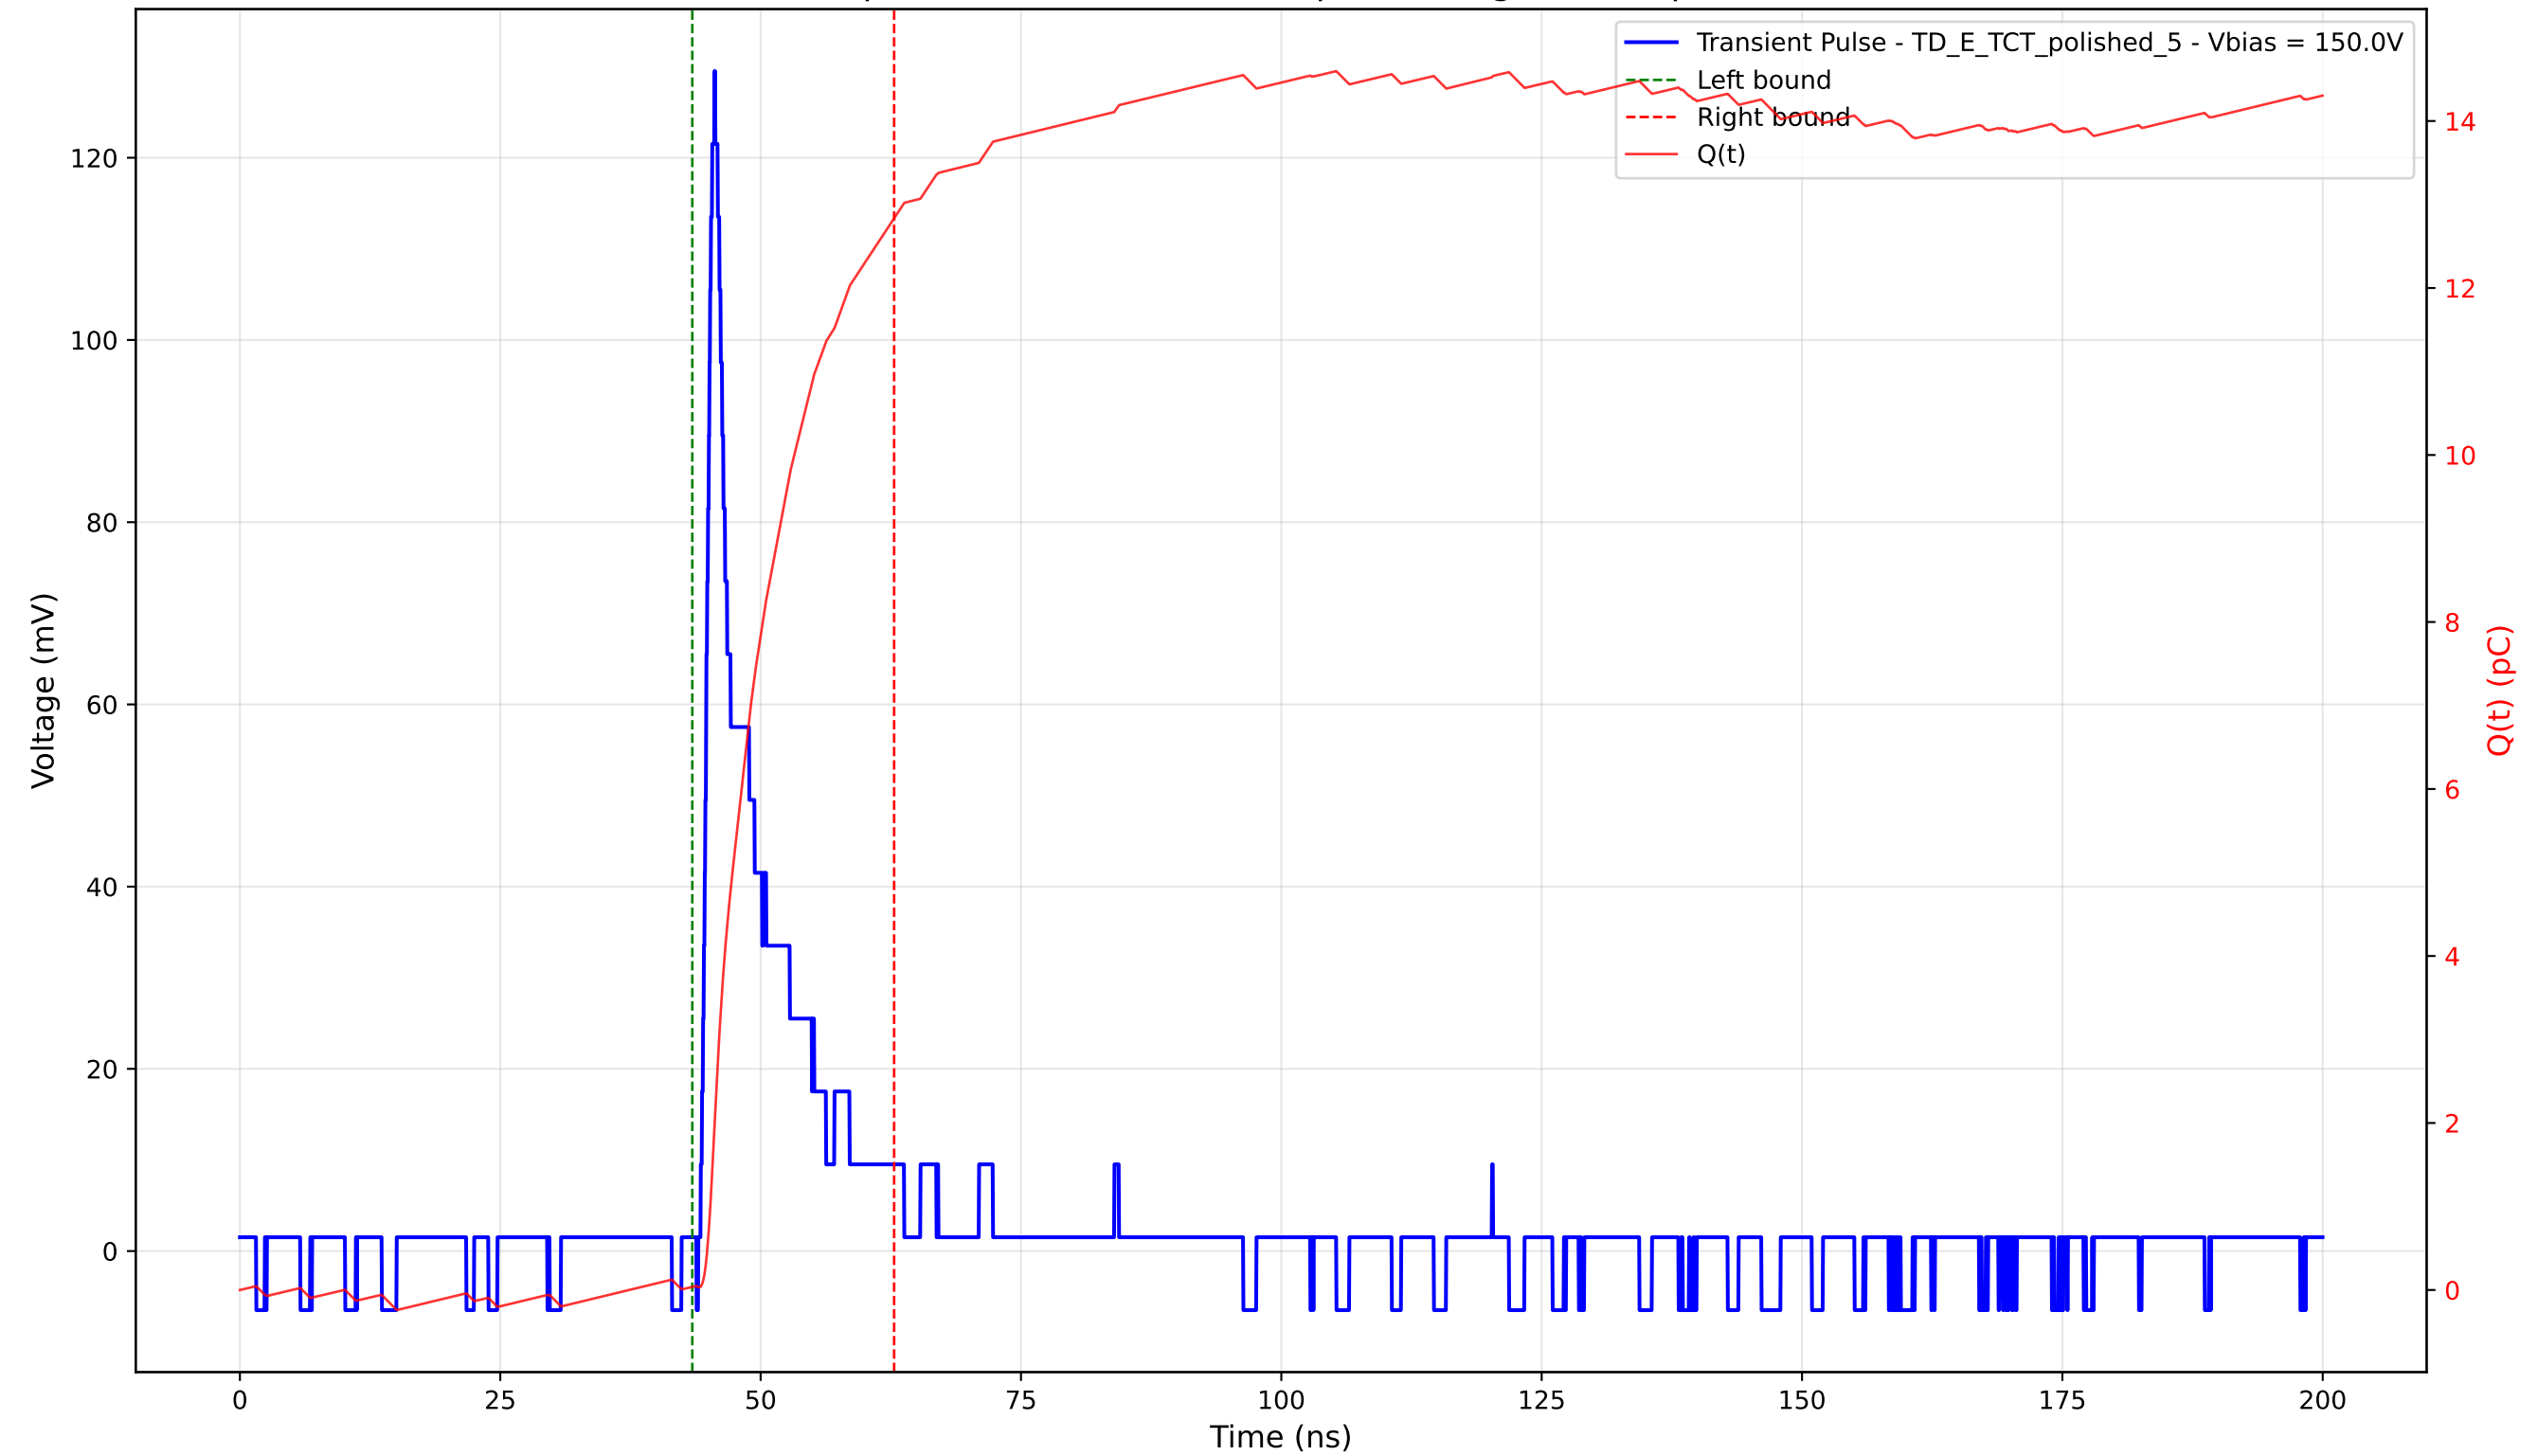


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 18.87 pC - Rise Time: 0.88 ns

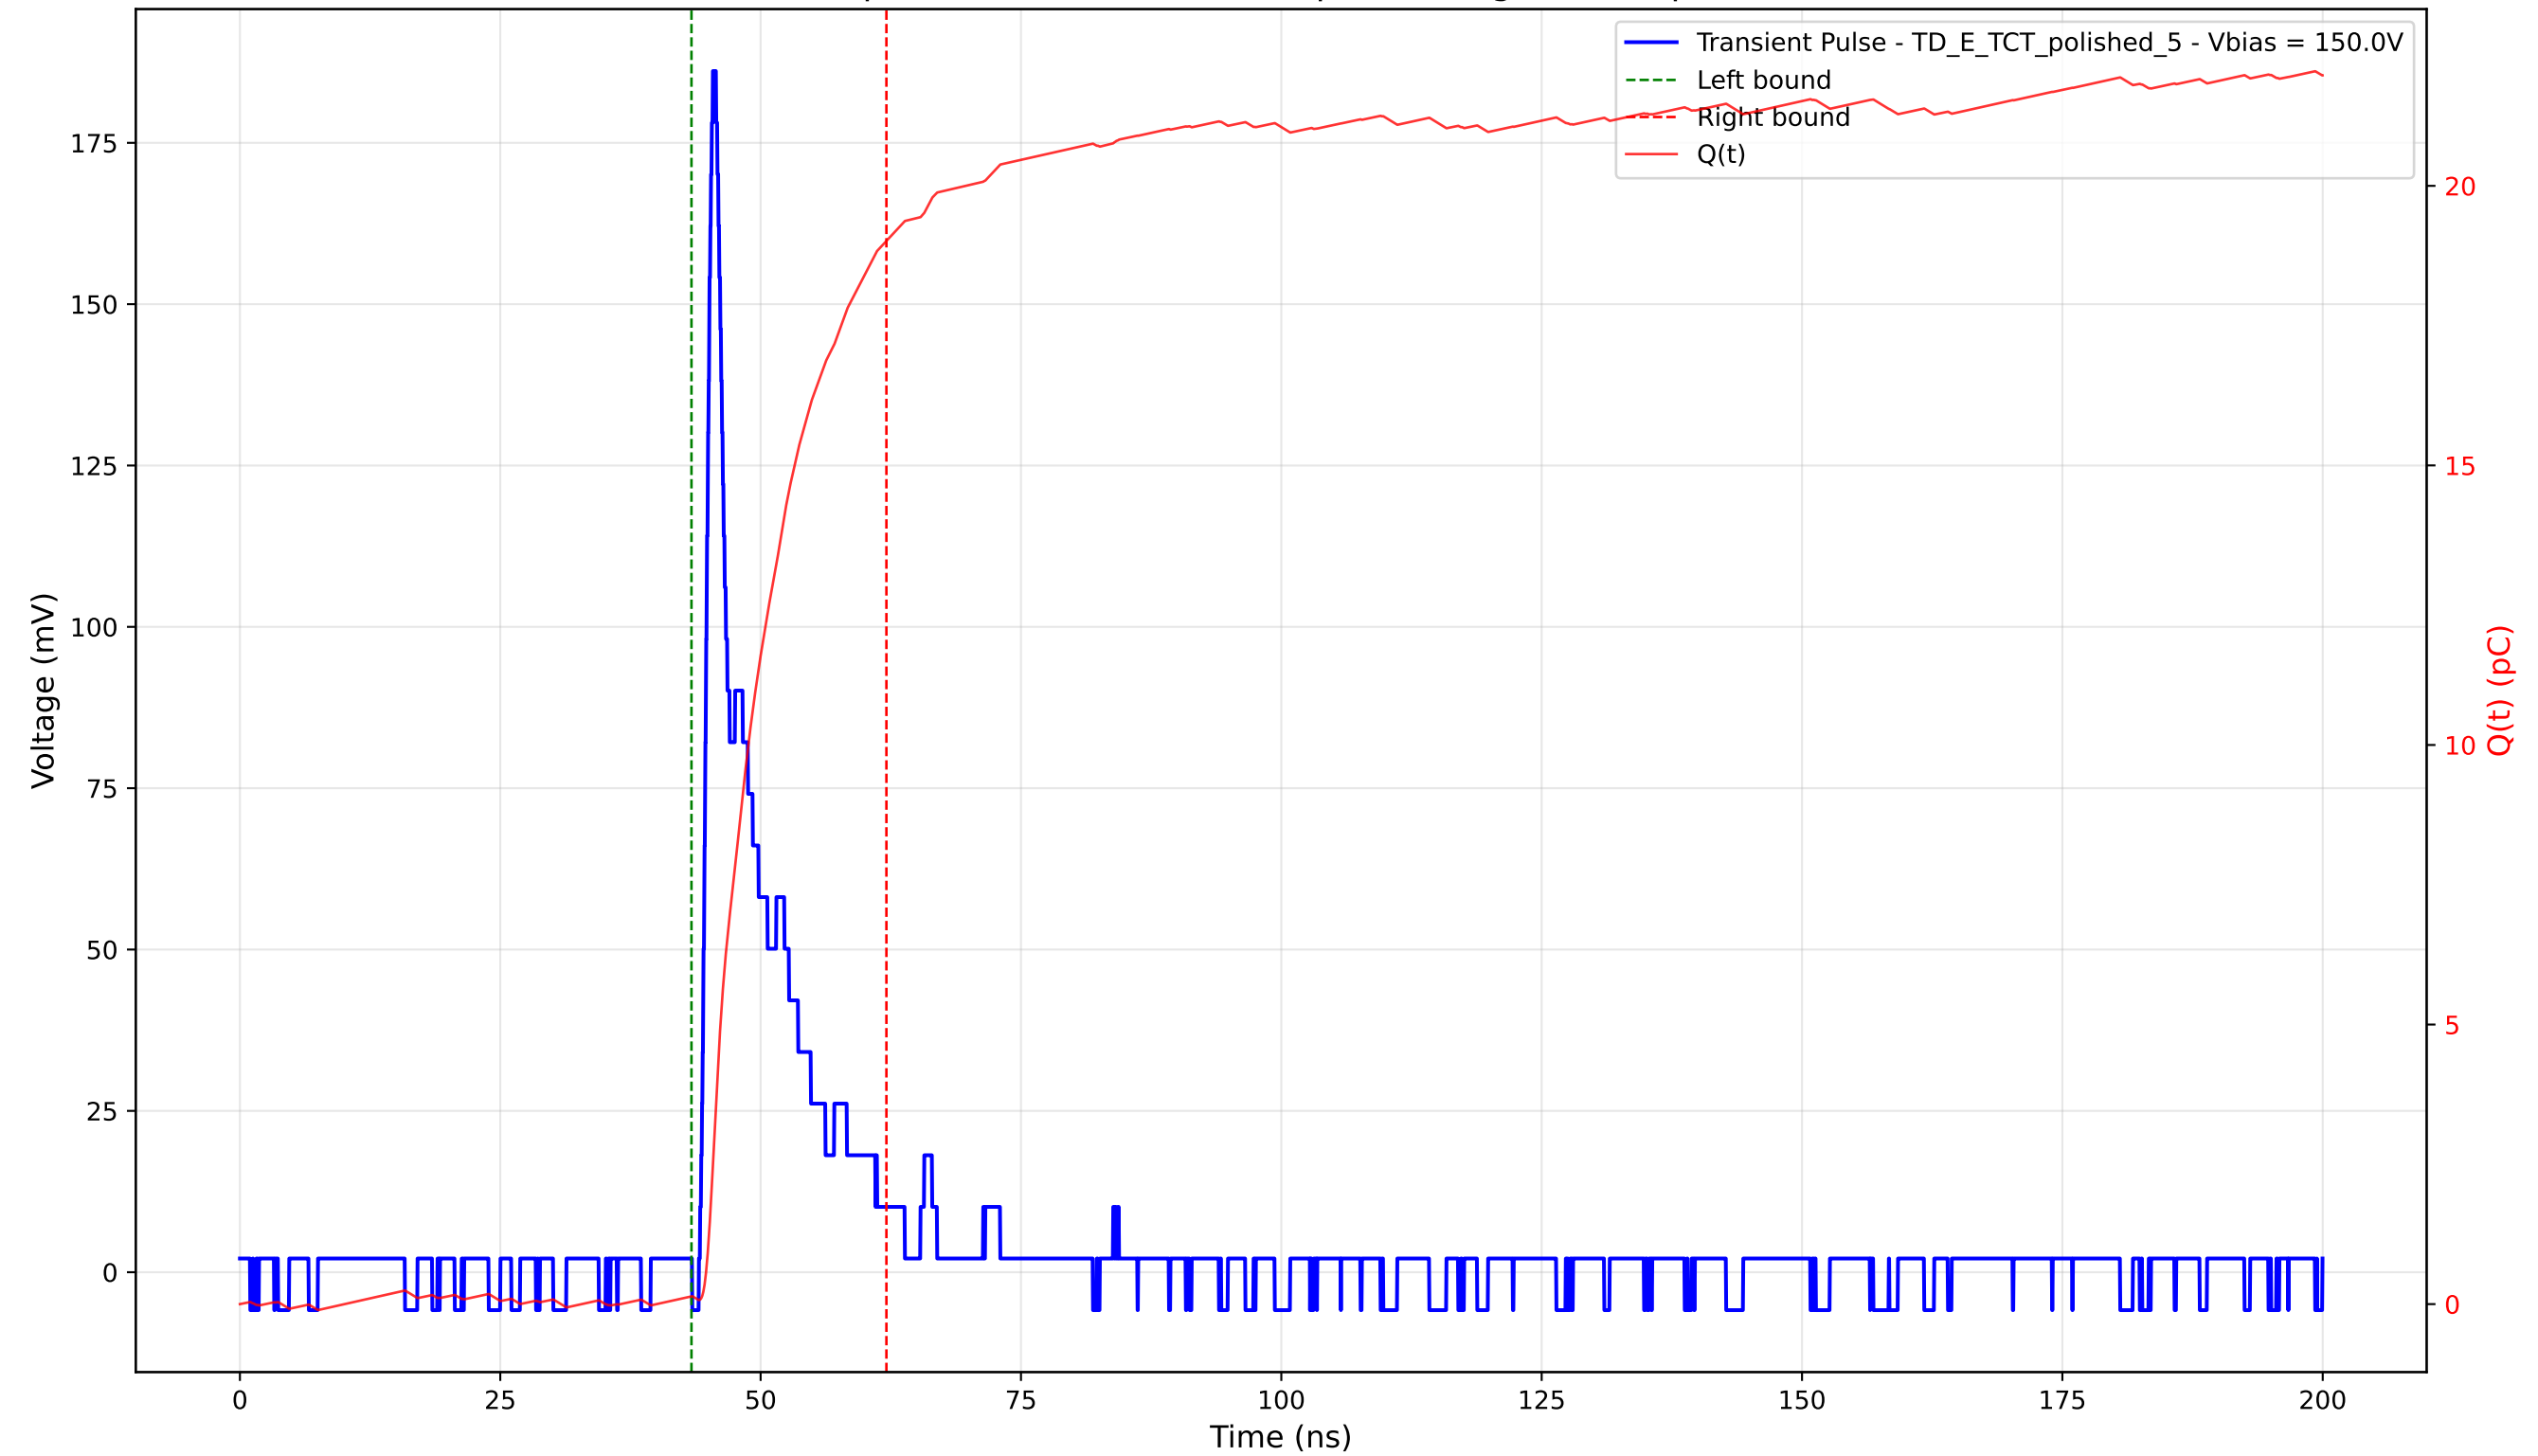


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 26.49 pC - Rise Time: 0.90 ns

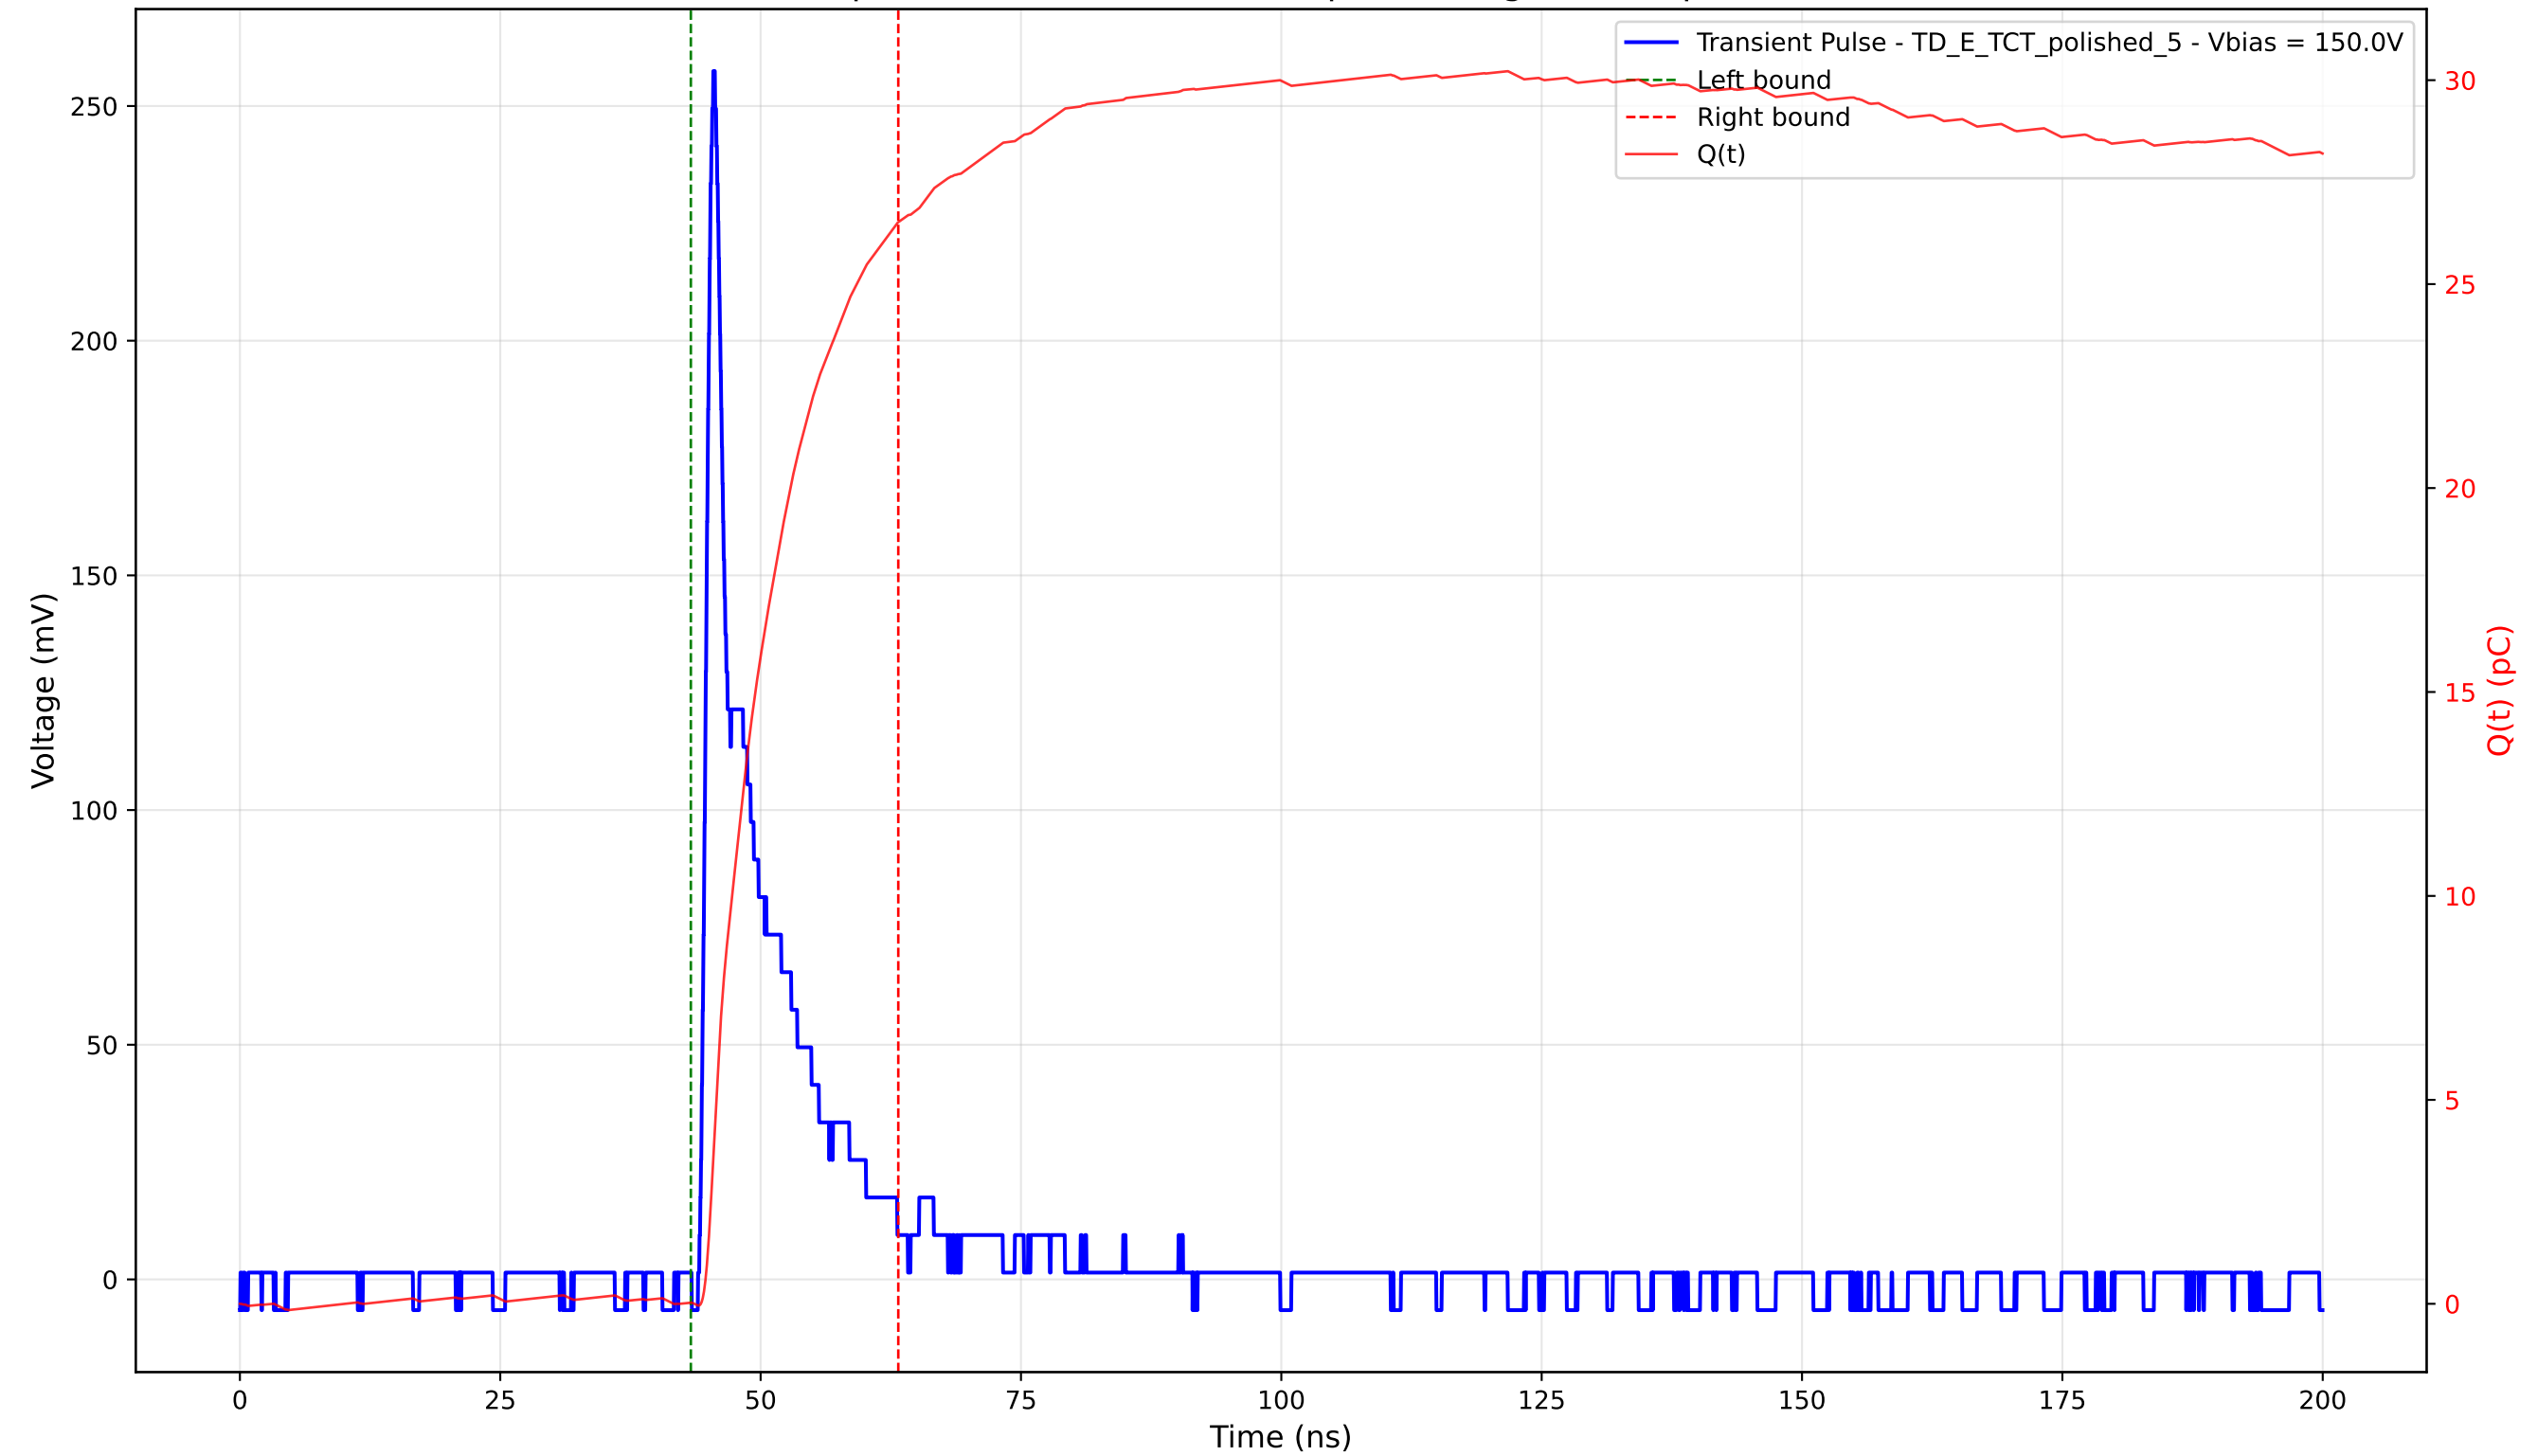


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 32.37 pC - Rise Time: 0.97 ns

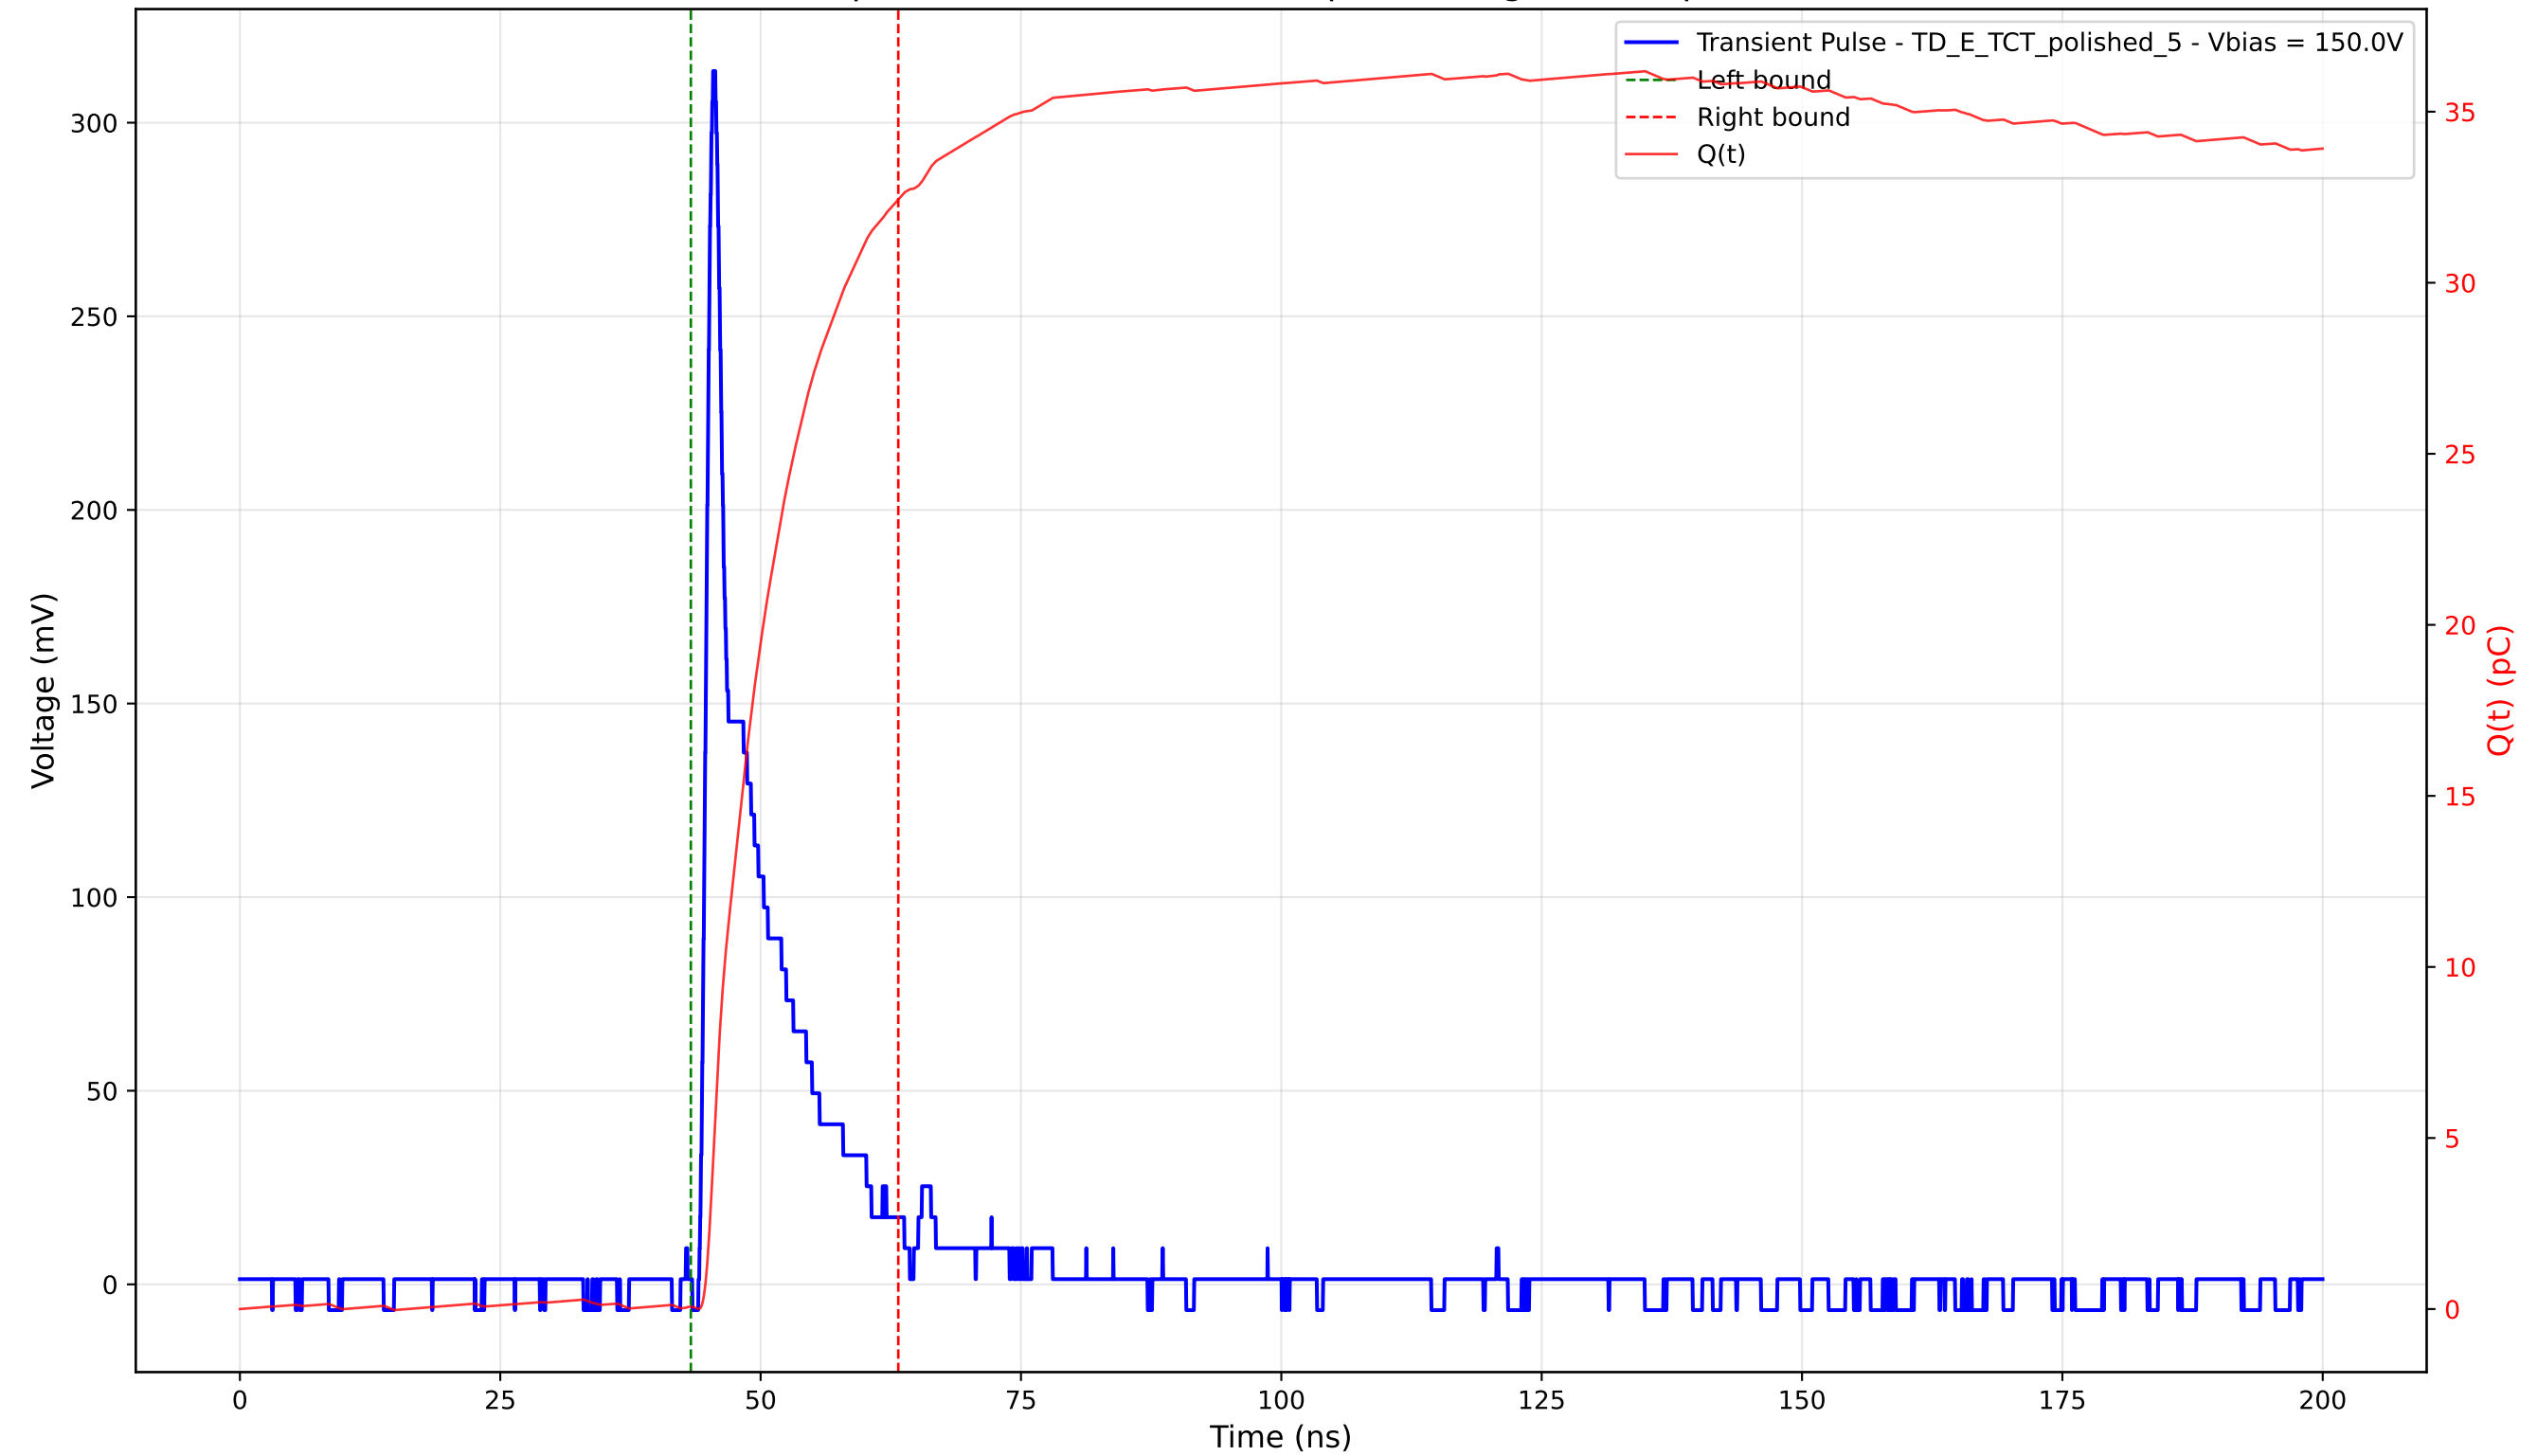


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 38.75 pC - Rise Time: 0.93 ns

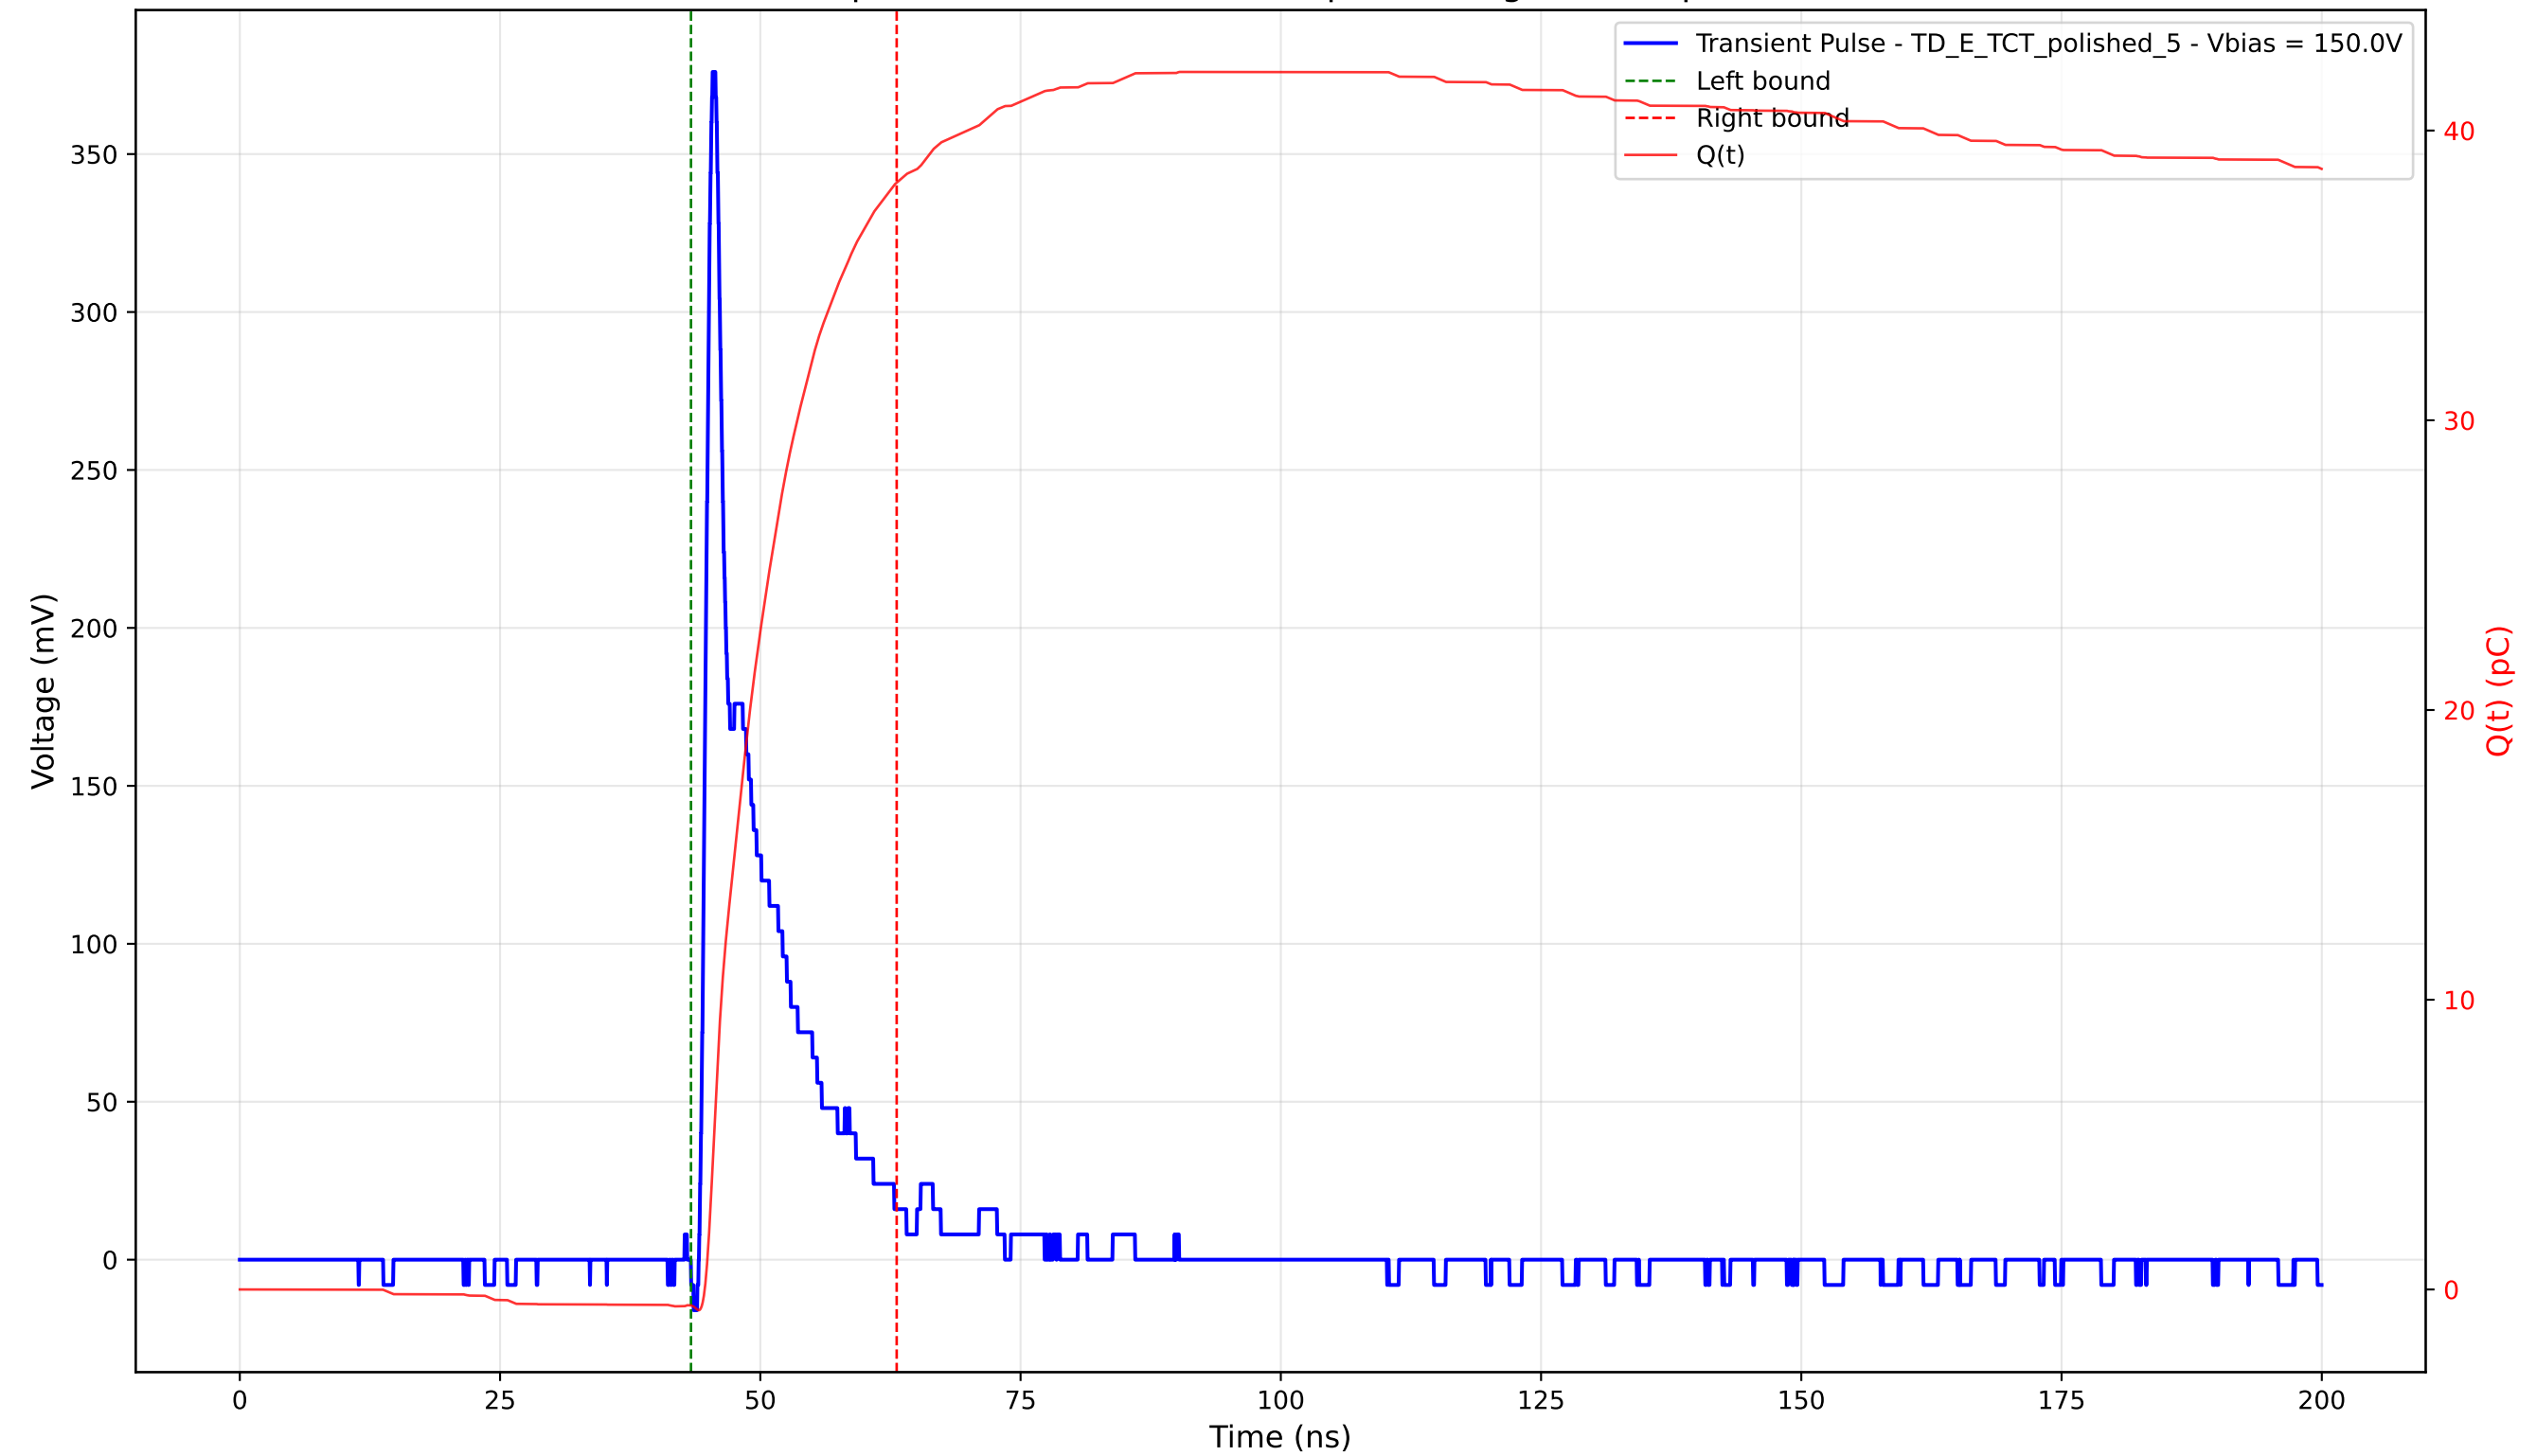


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 45.13 pC - Rise Time: 0.92 ns

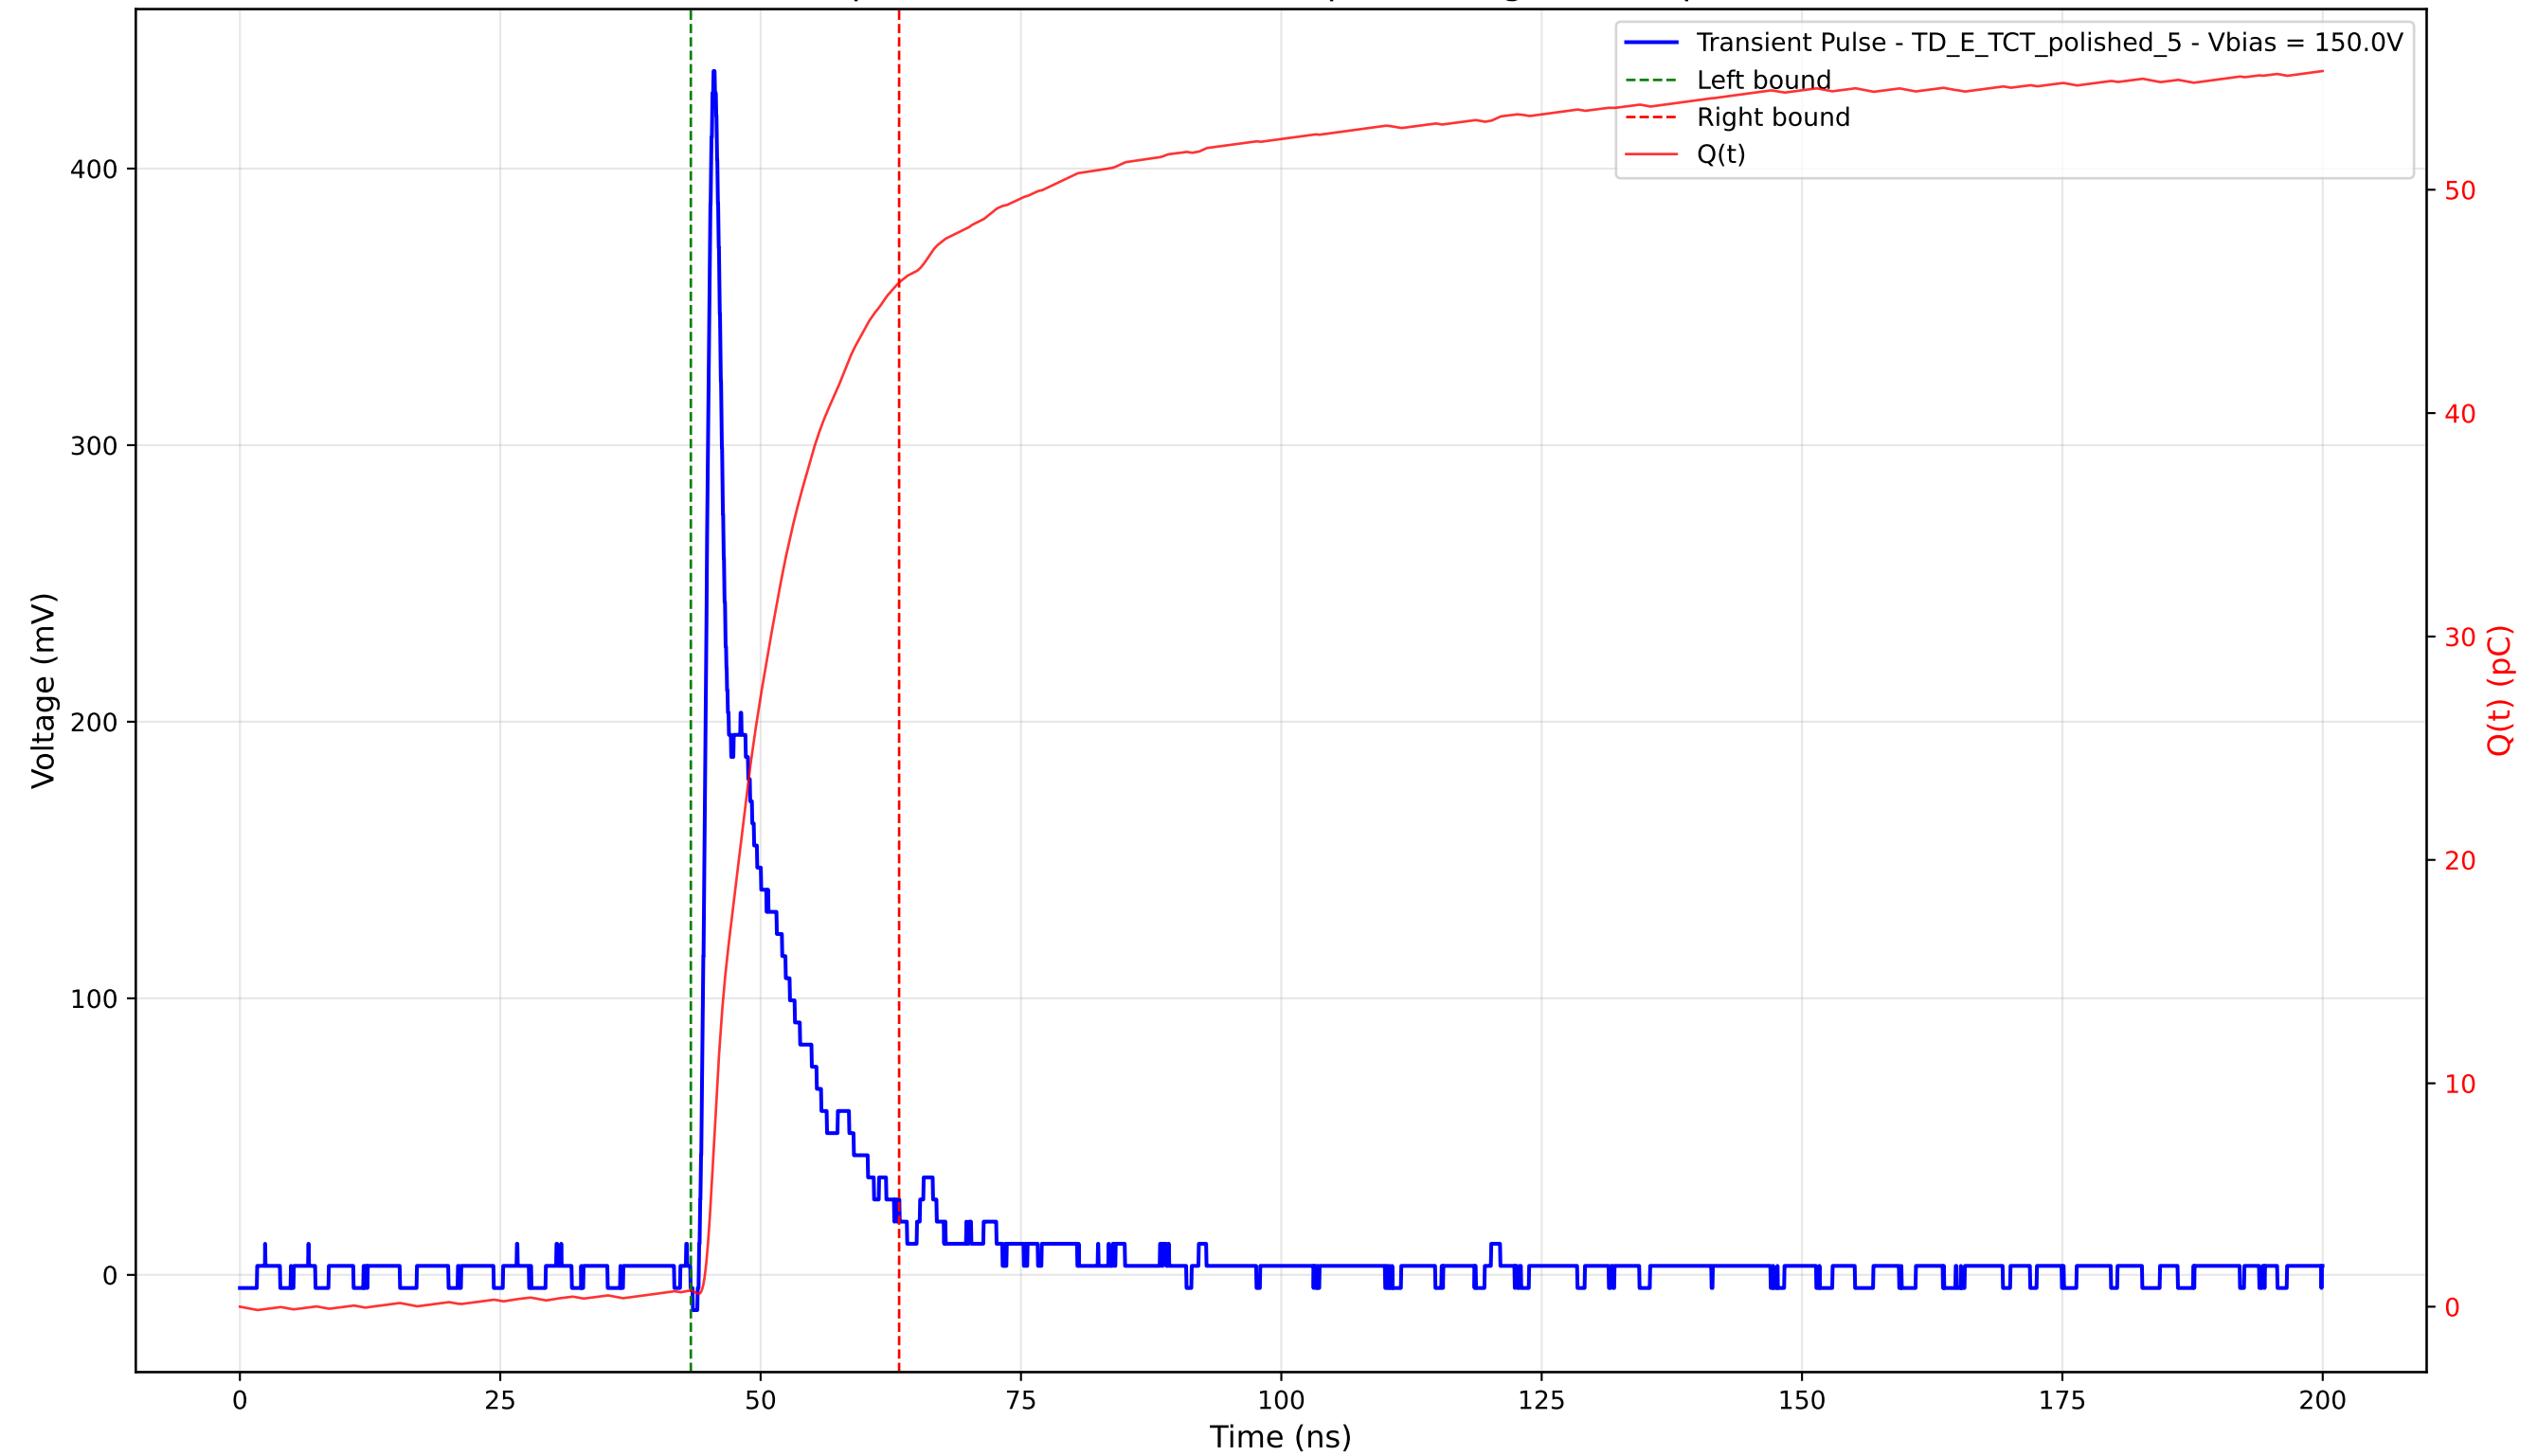


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 47.47 pC - Rise Time: 0.95 ns

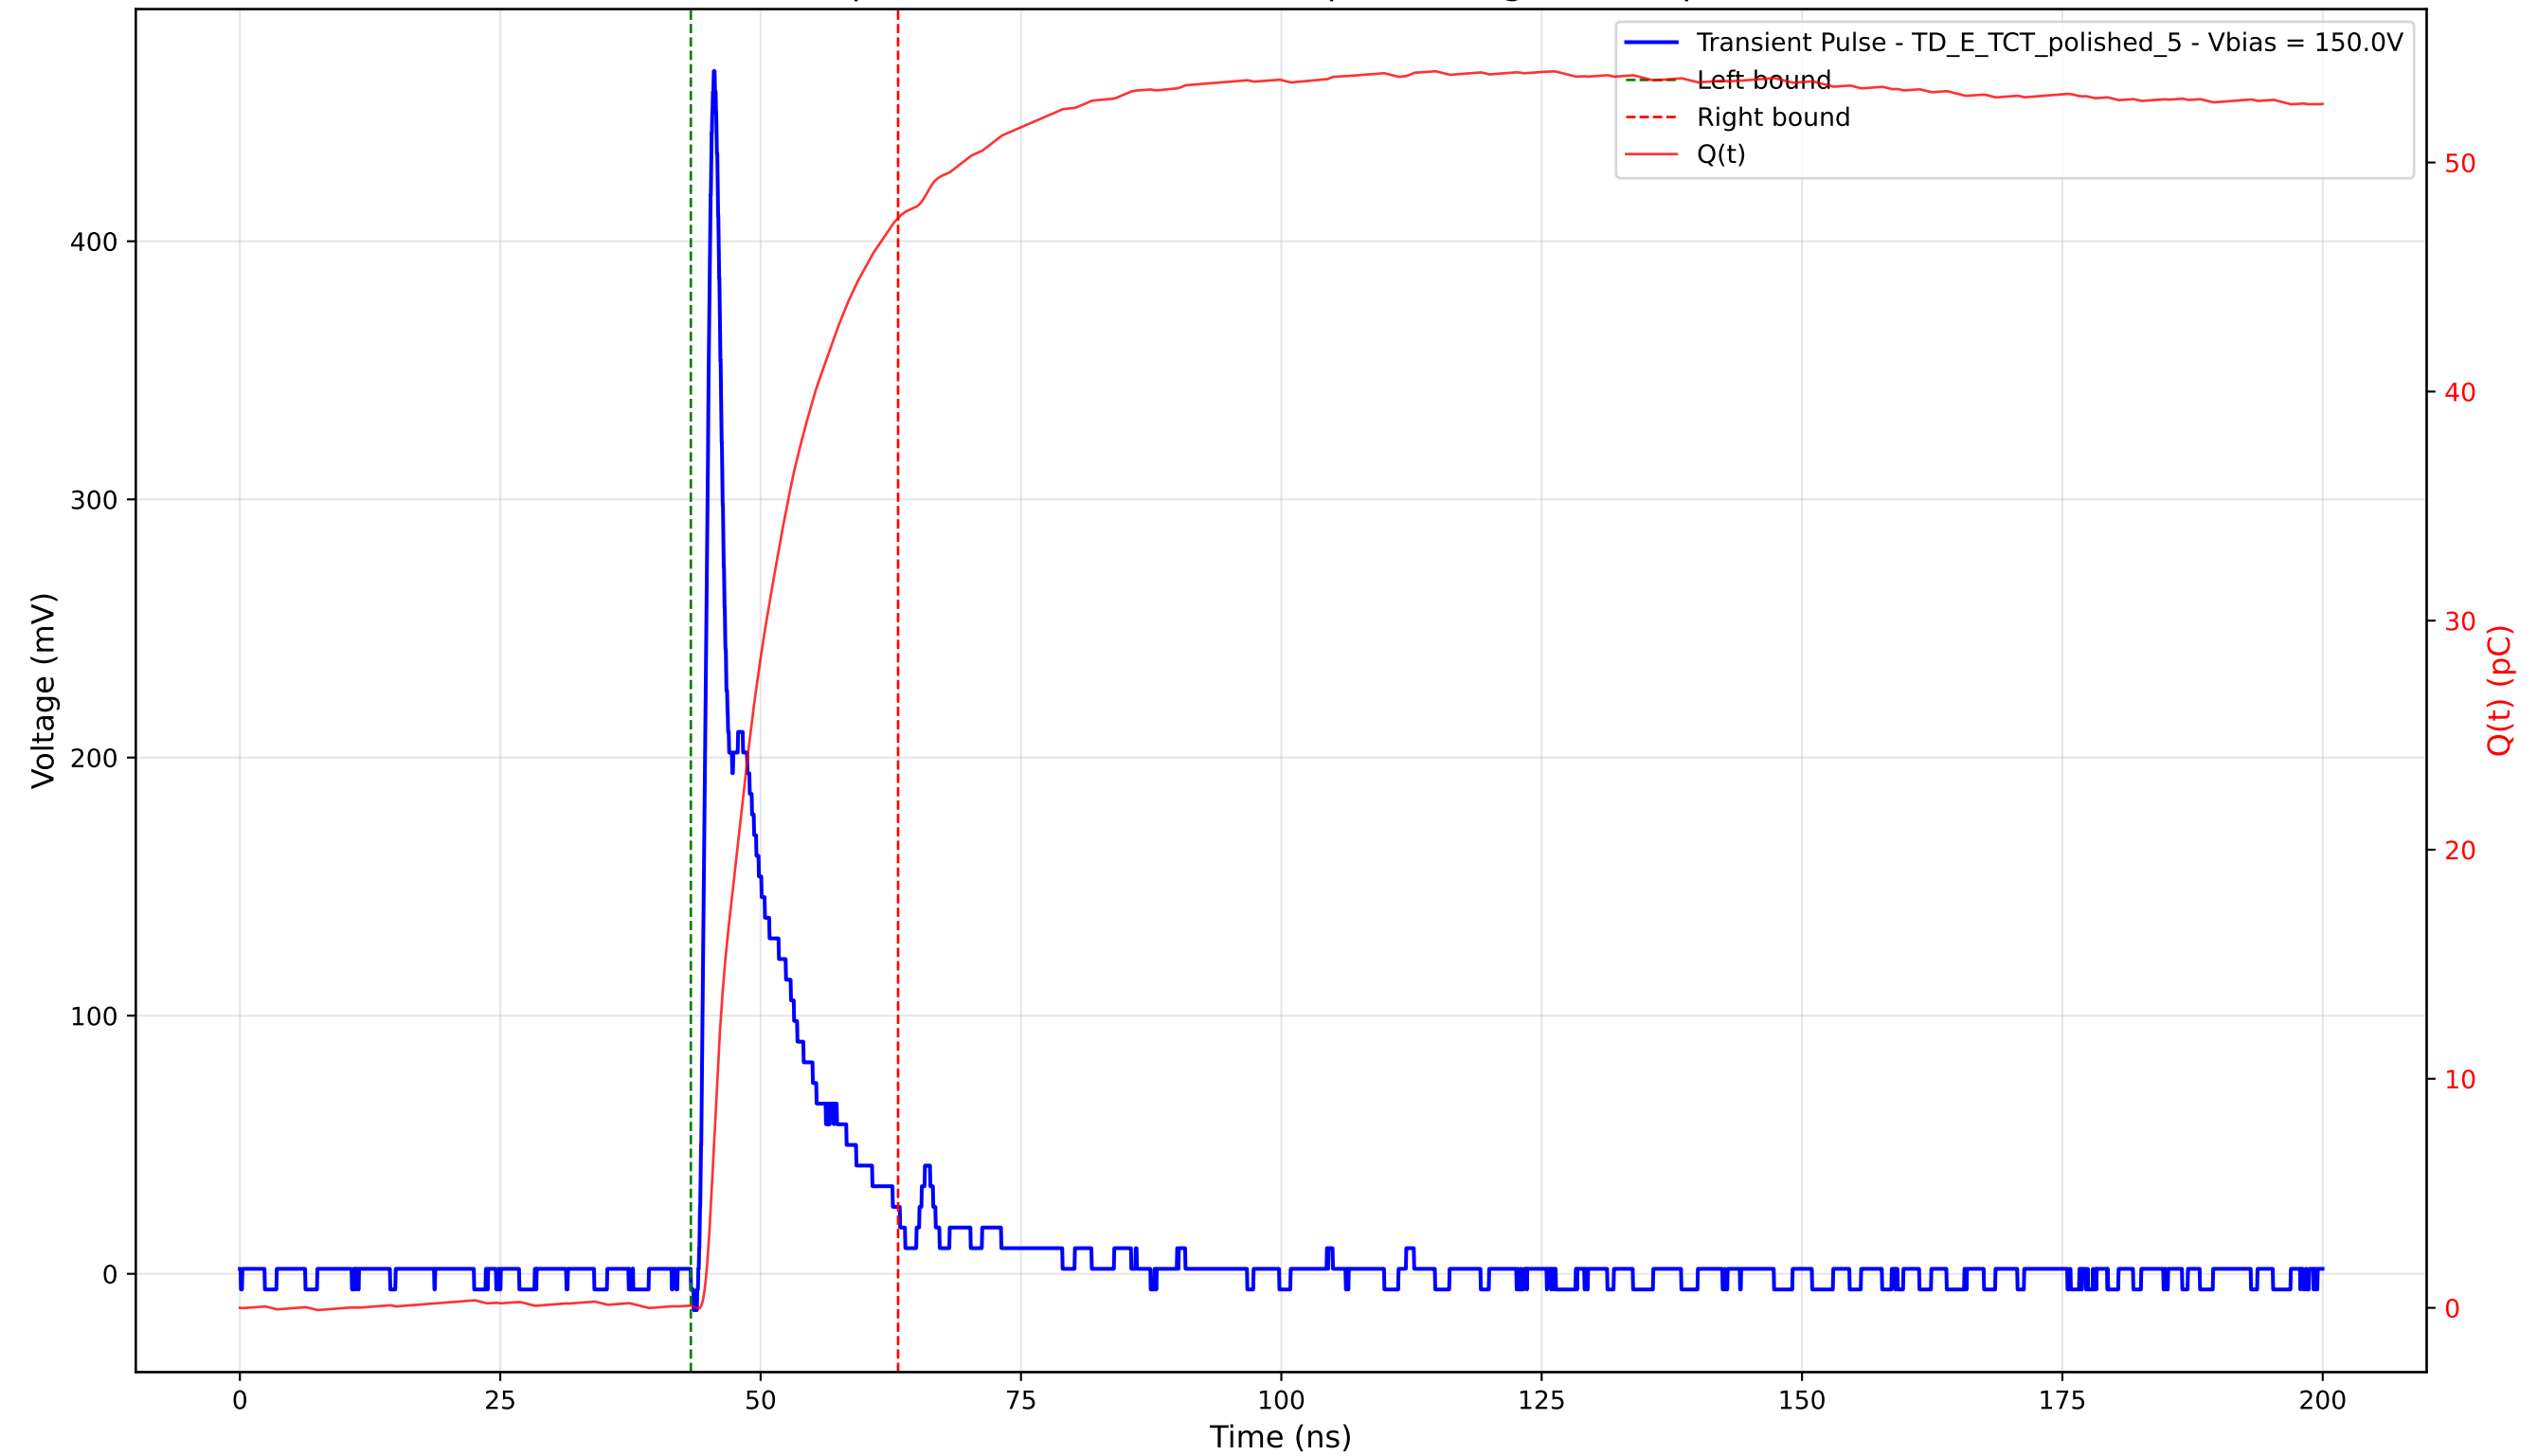


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 49.58 pC - Rise Time: 0.95 ns

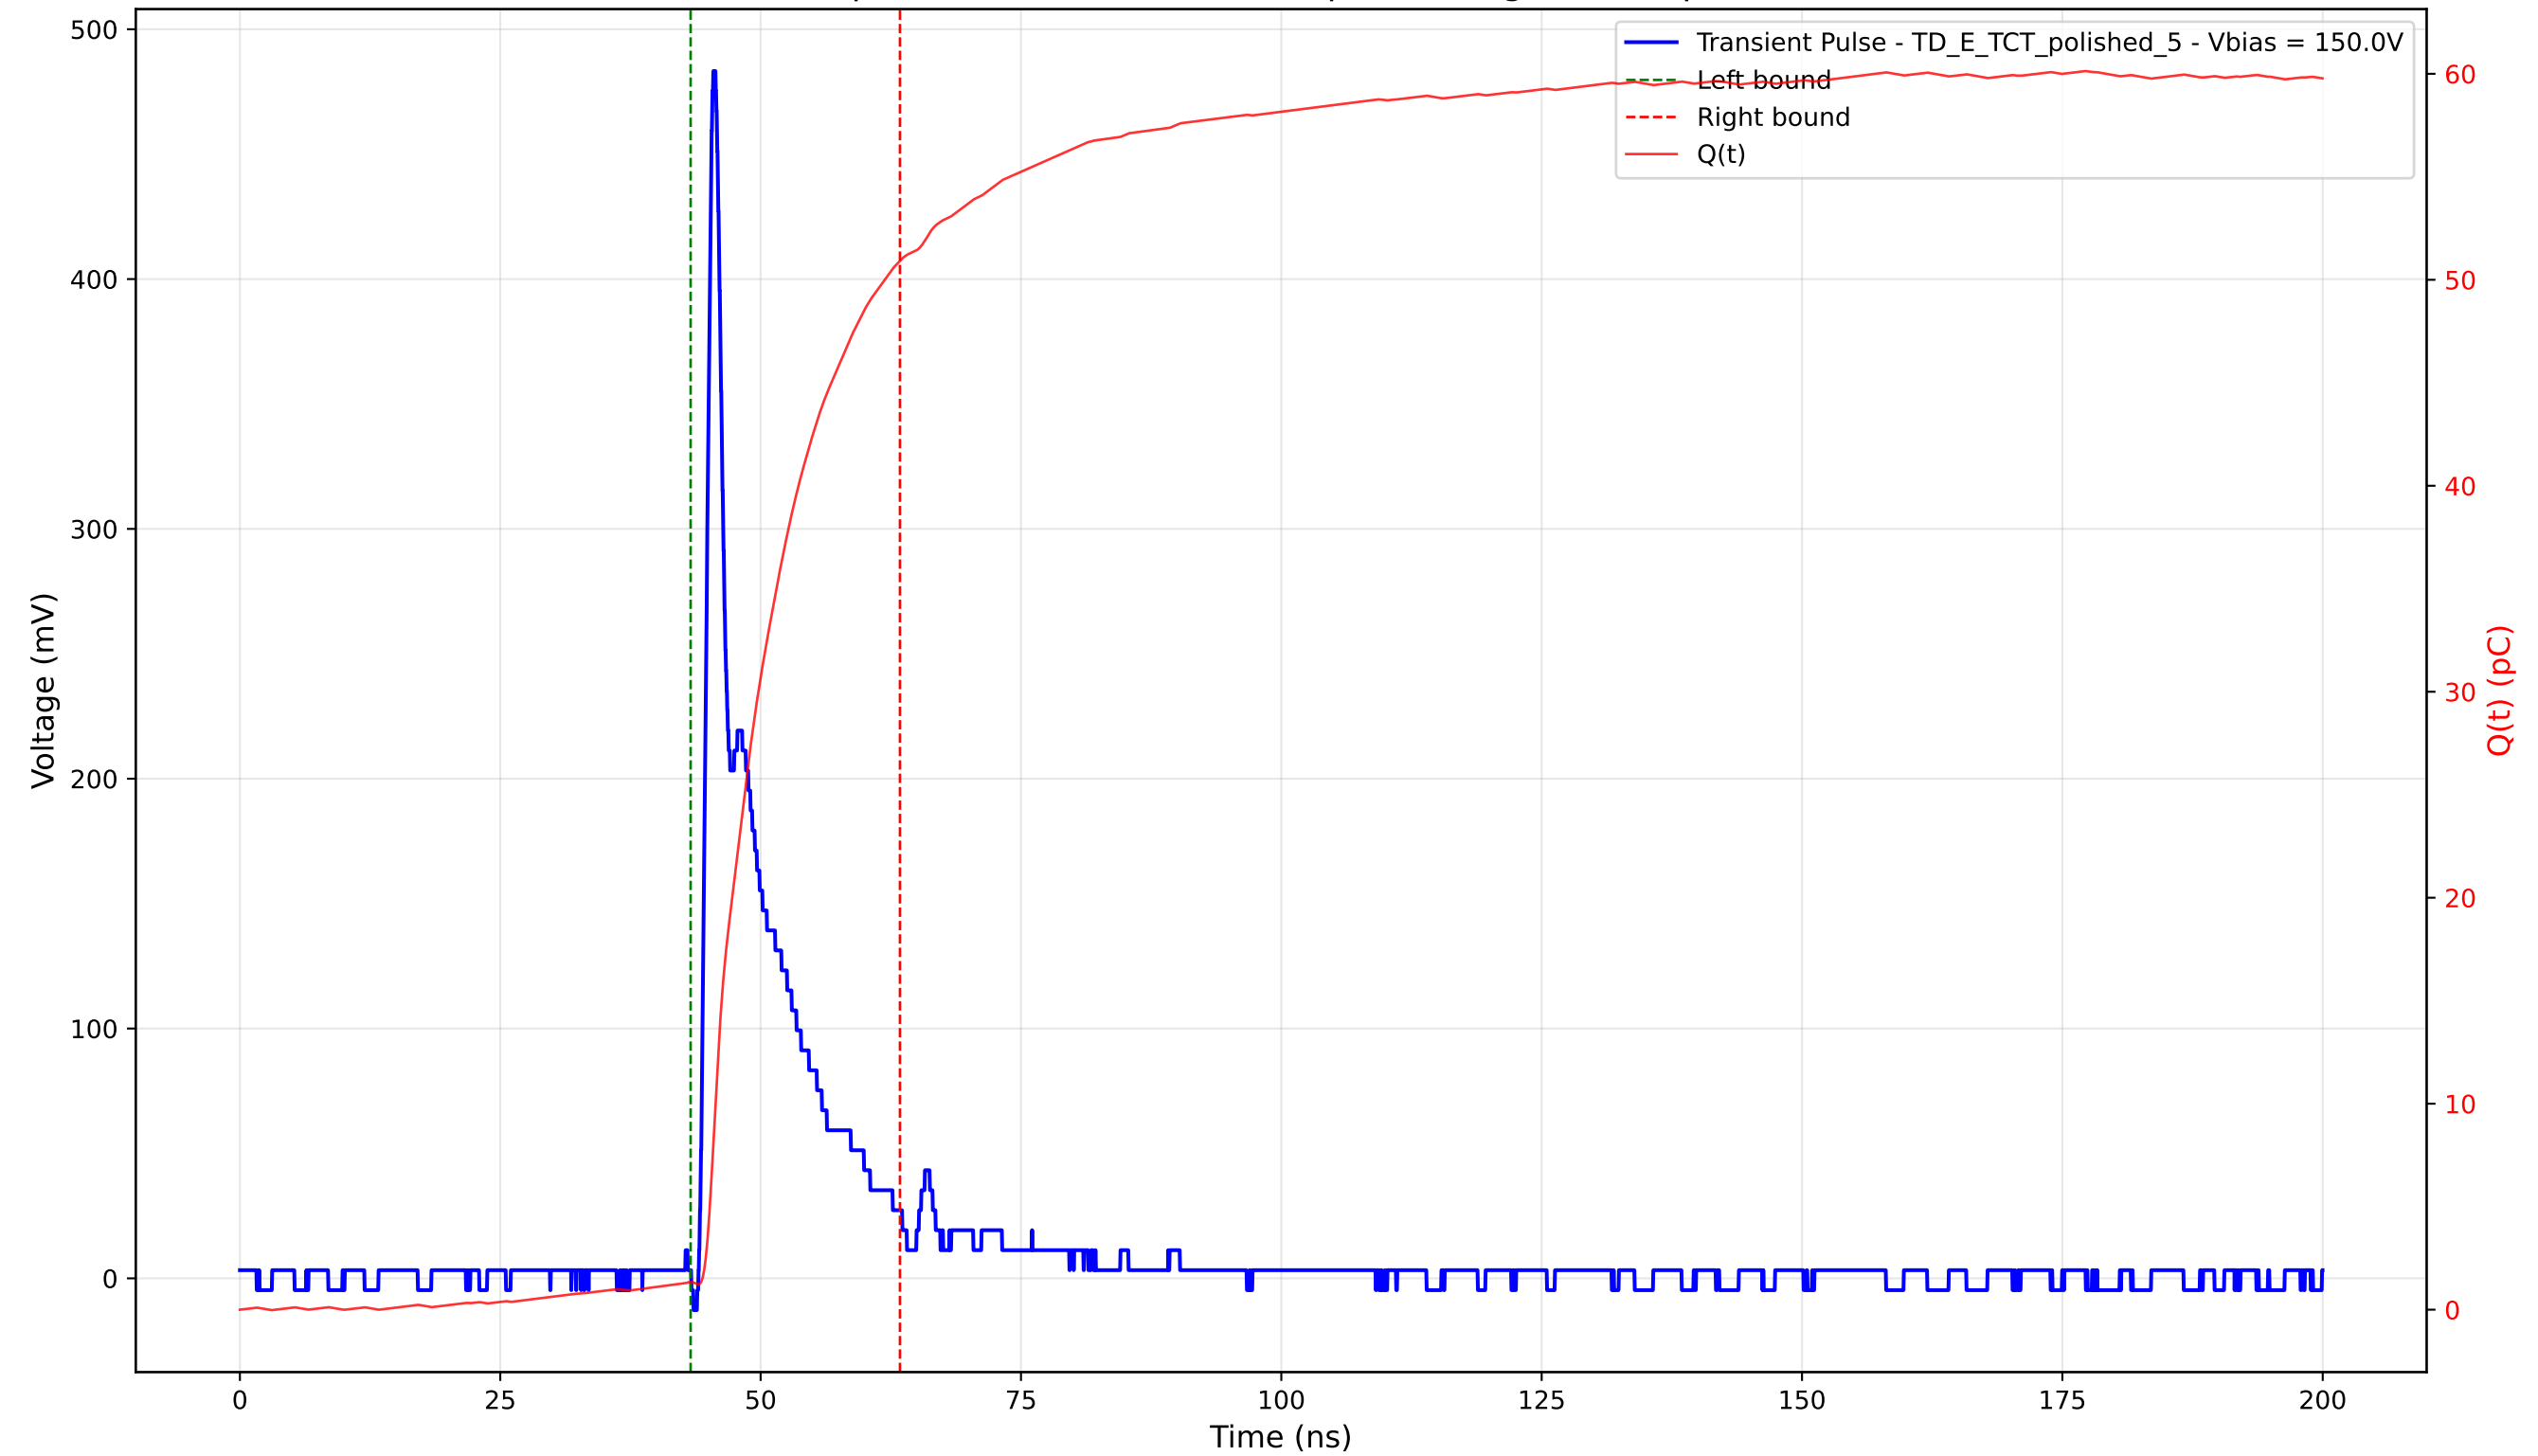


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 49.01 pC - Rise Time: 0.94 ns

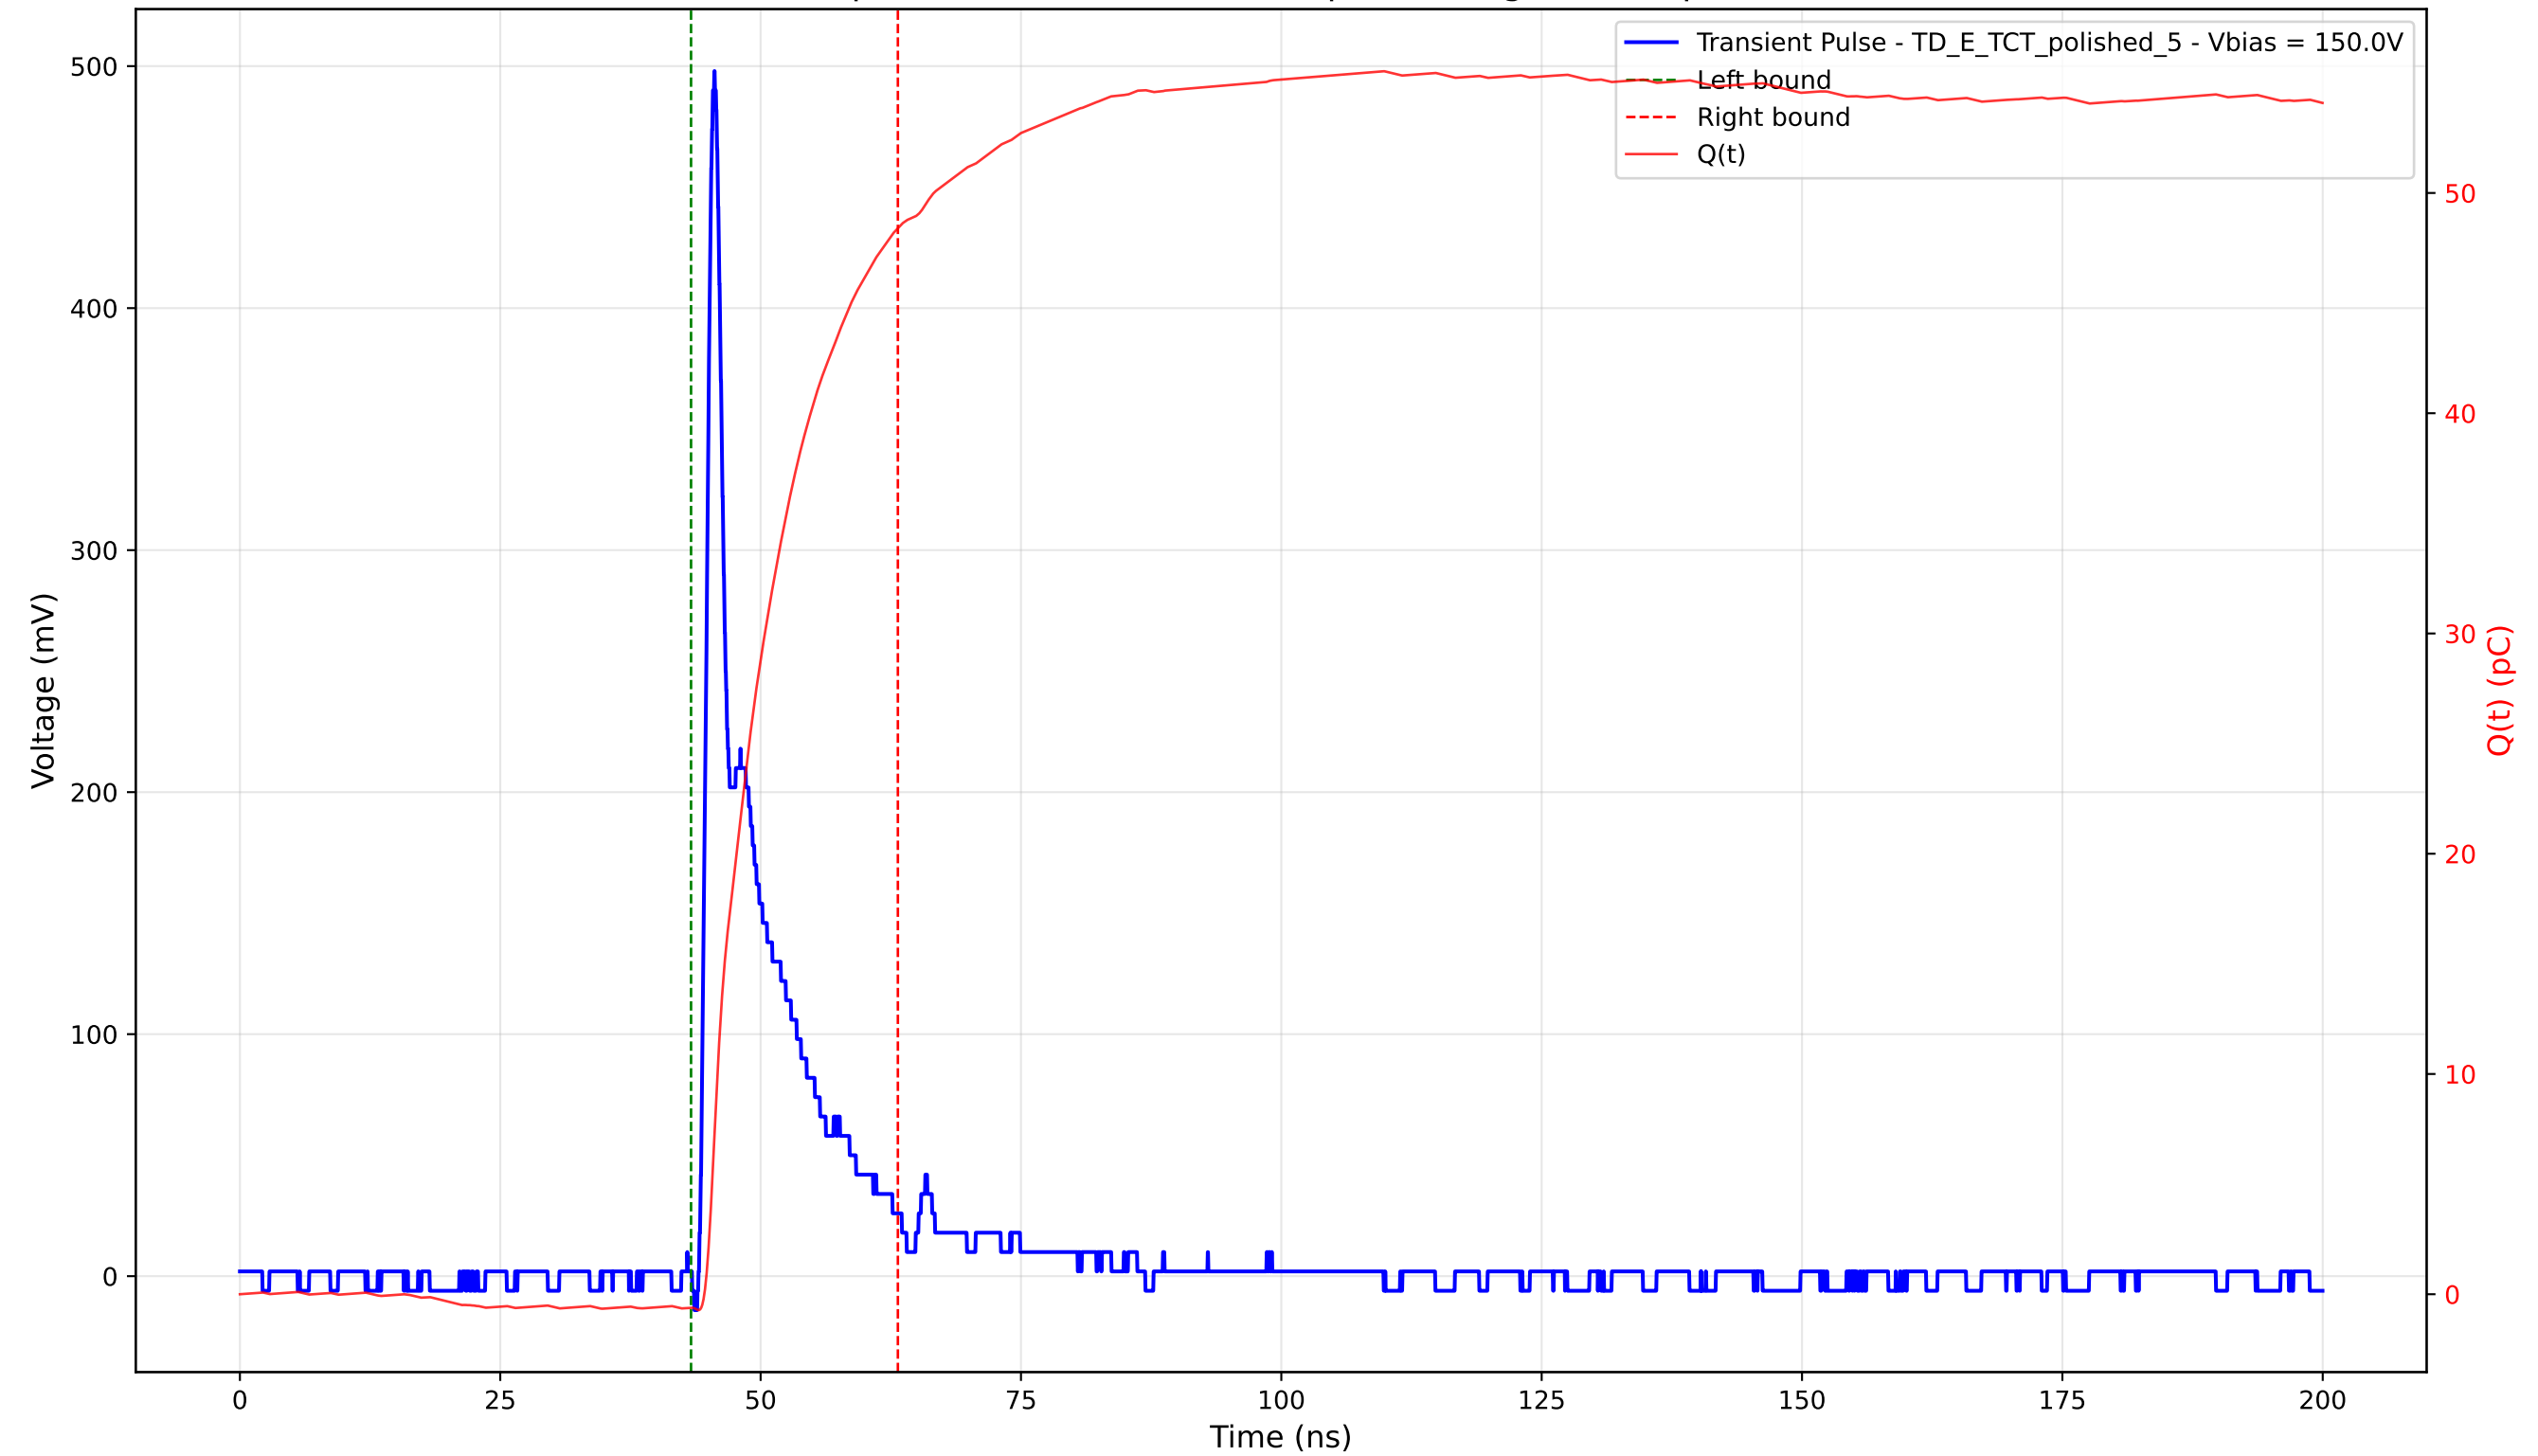


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 48.56 pC - Rise Time: 0.96 ns

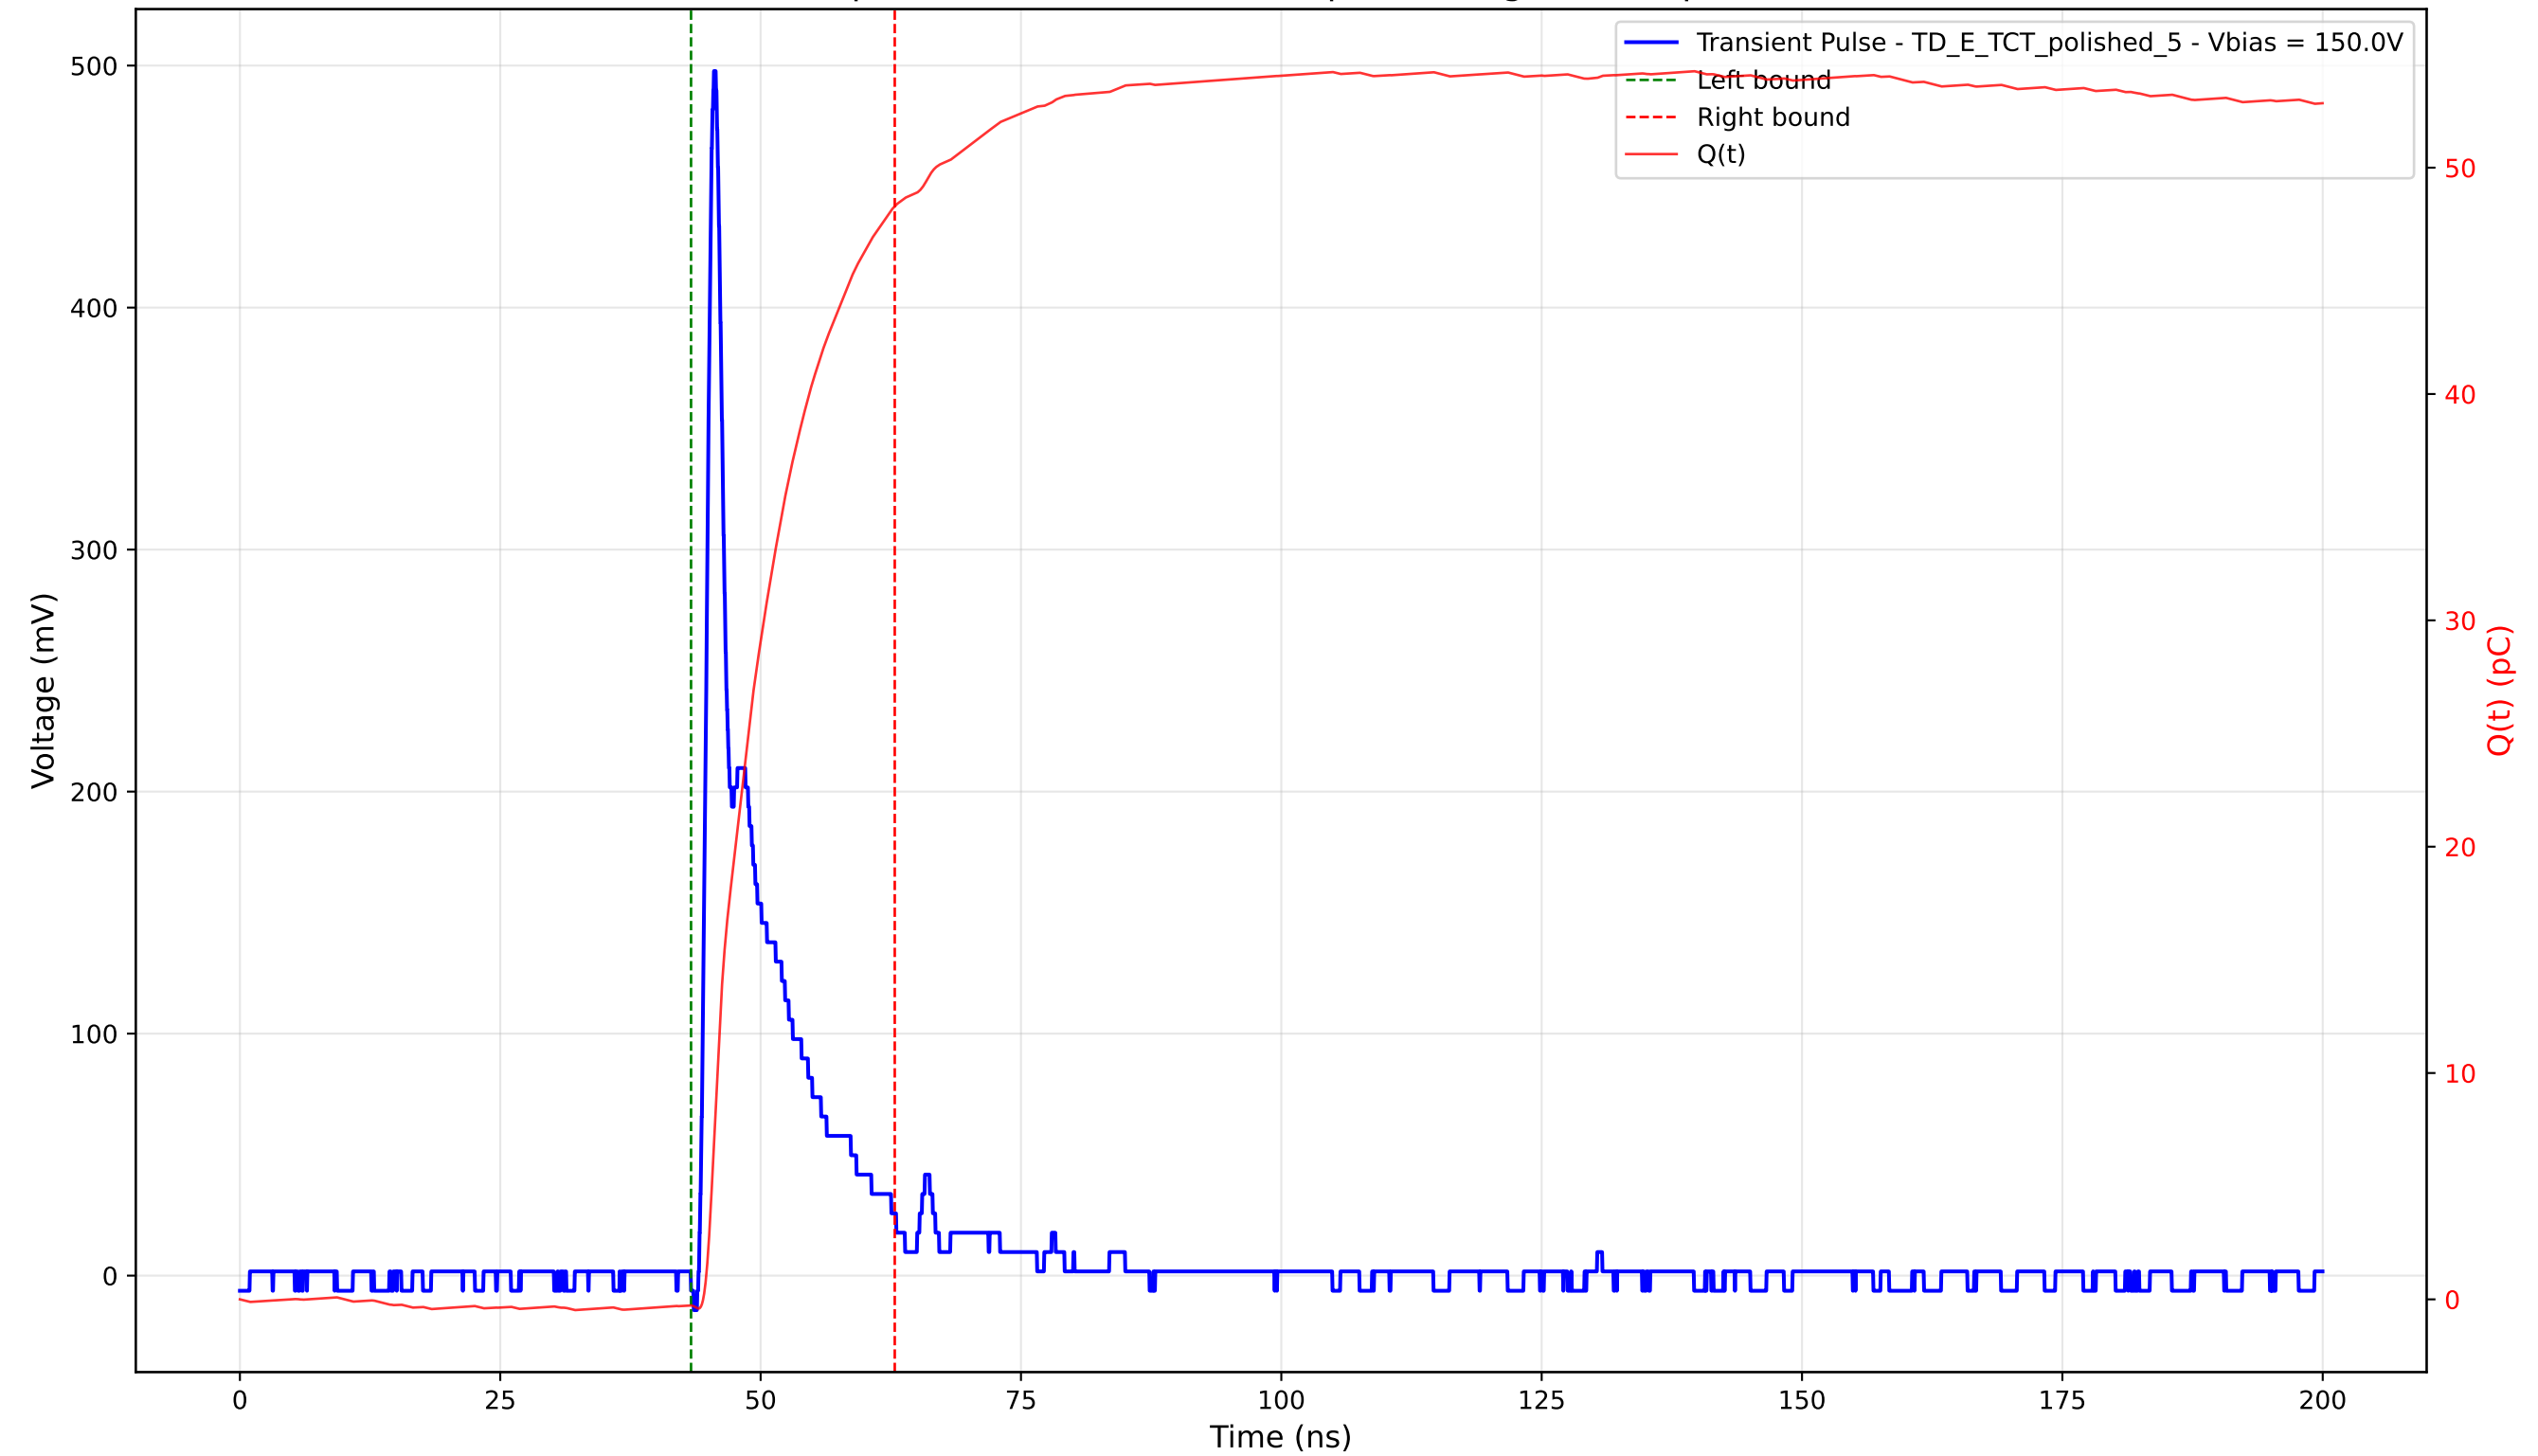


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 48.27 pC - Rise Time: 0.97 ns

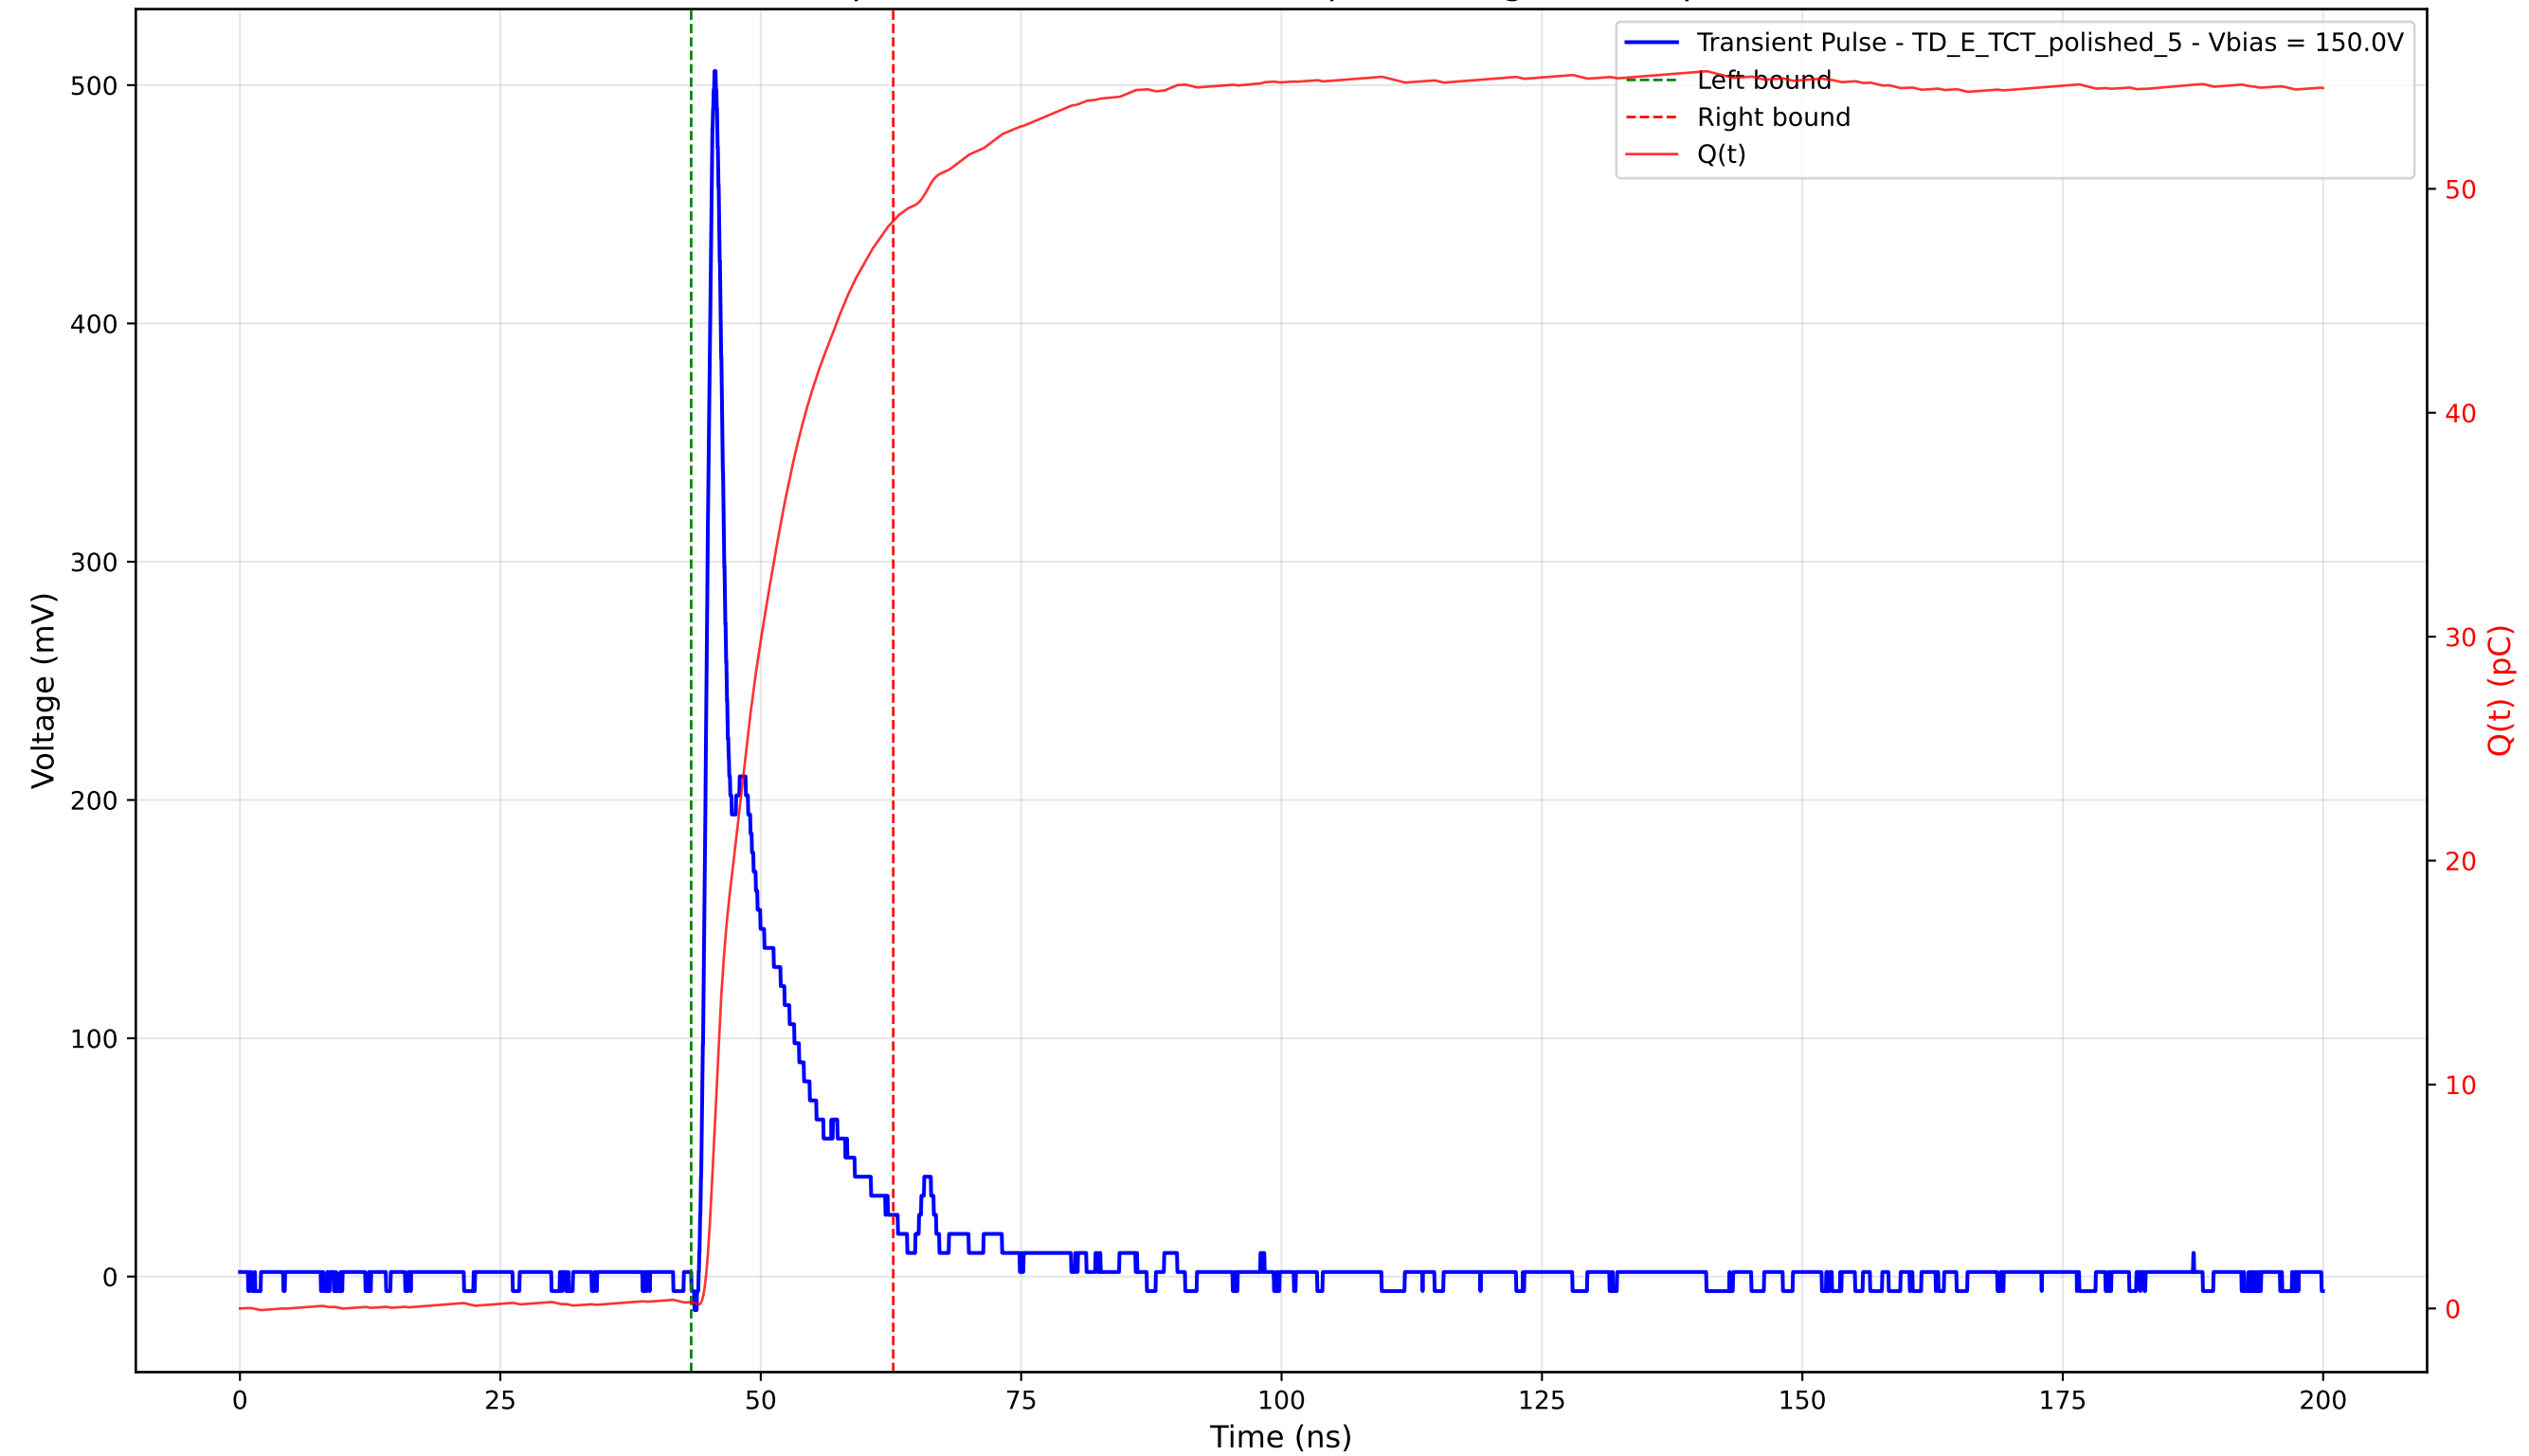


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 48.56 pC - Rise Time: 1.00 ns

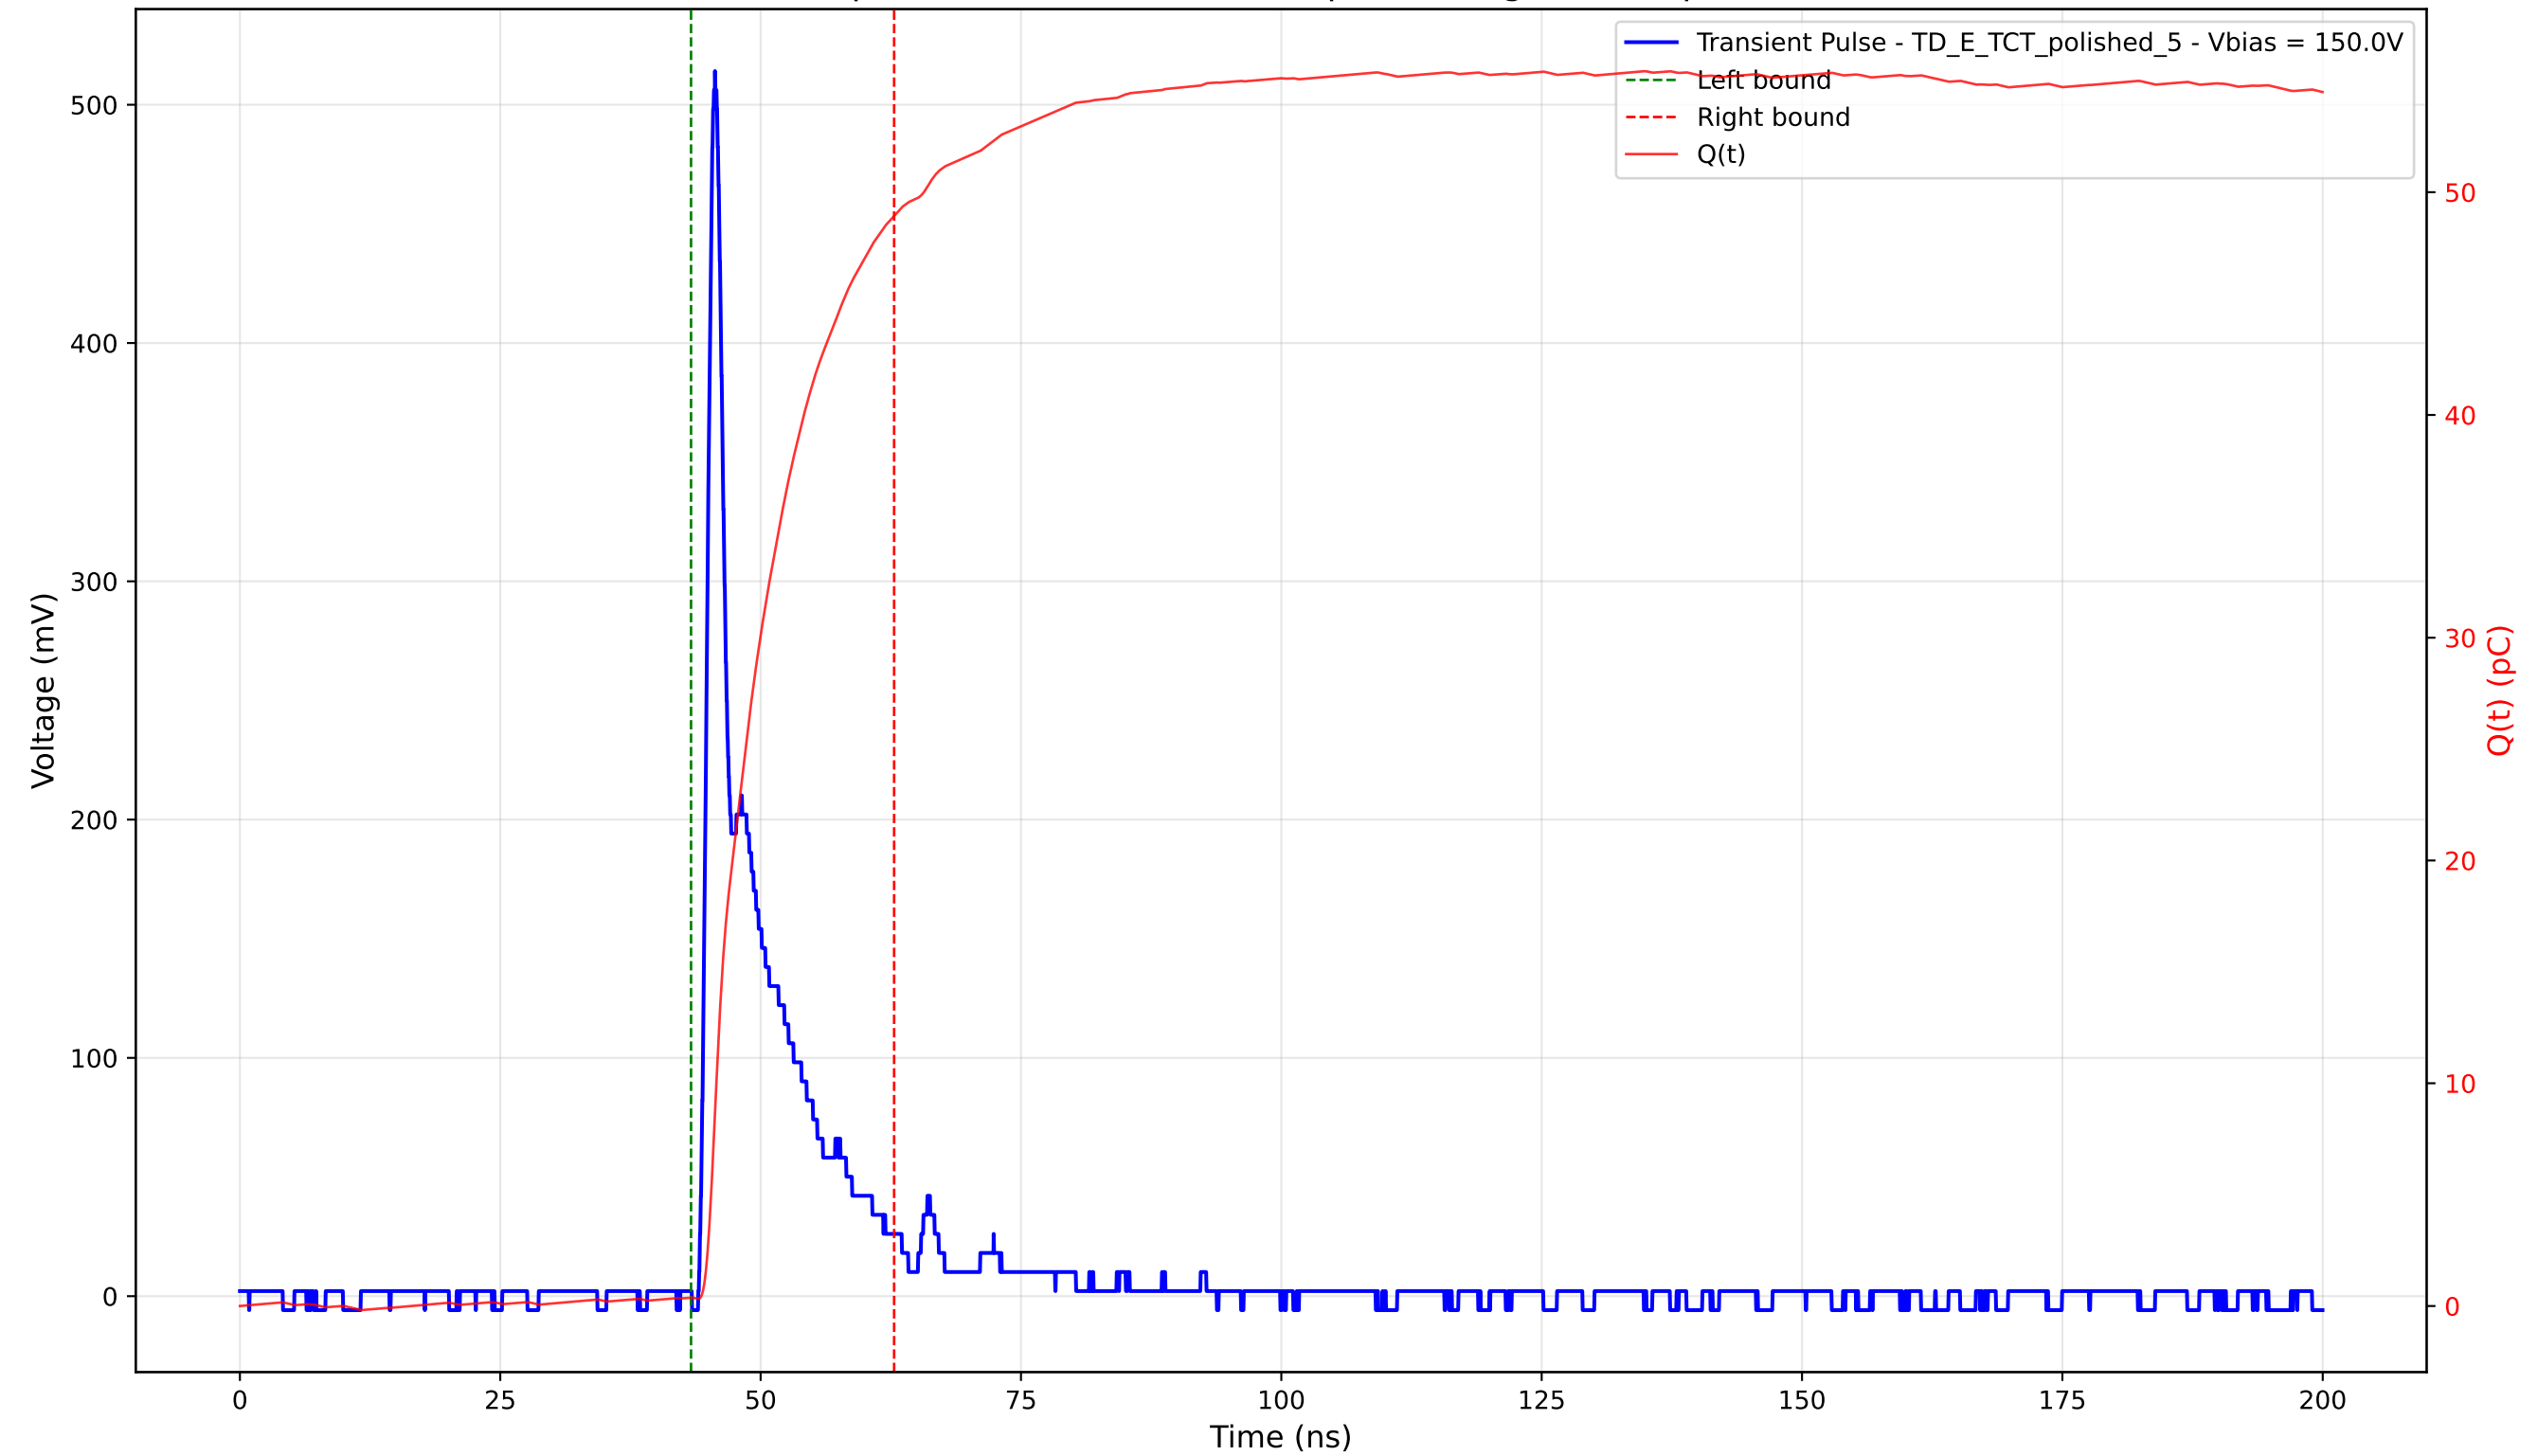


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 47.37 pC - Rise Time: 0.98 ns

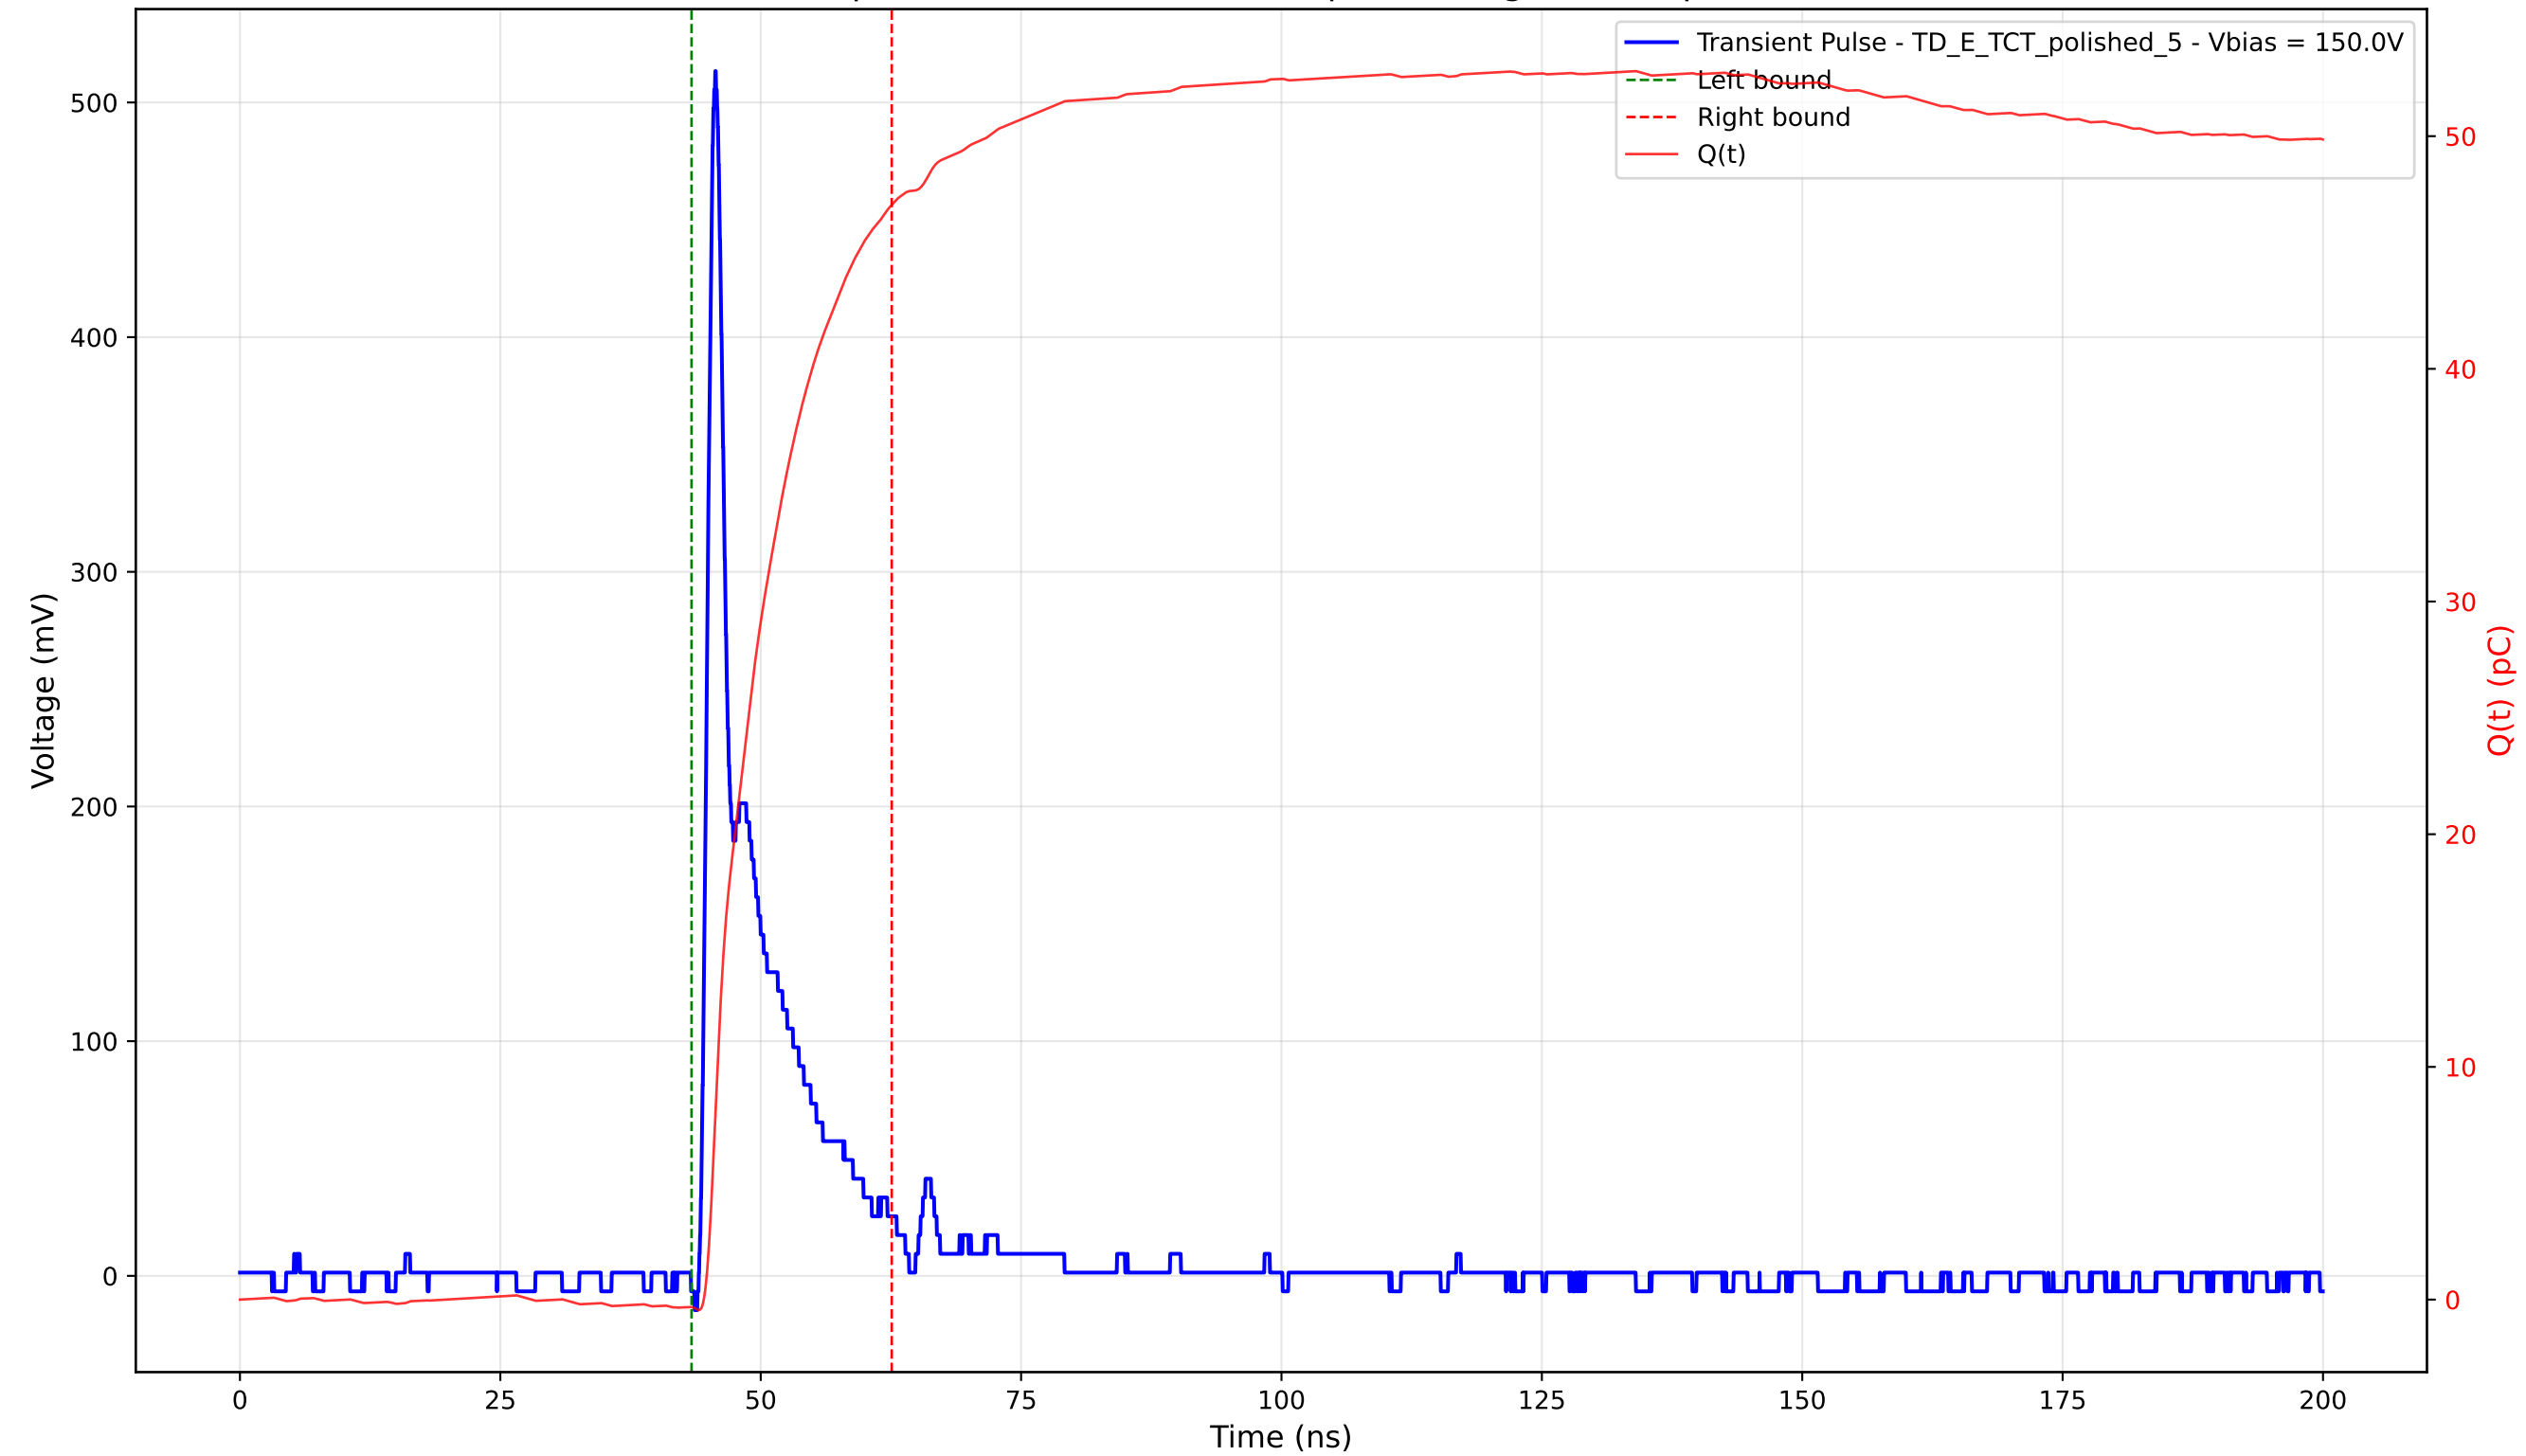


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 48.44 pC - Rise Time: 1.02 ns

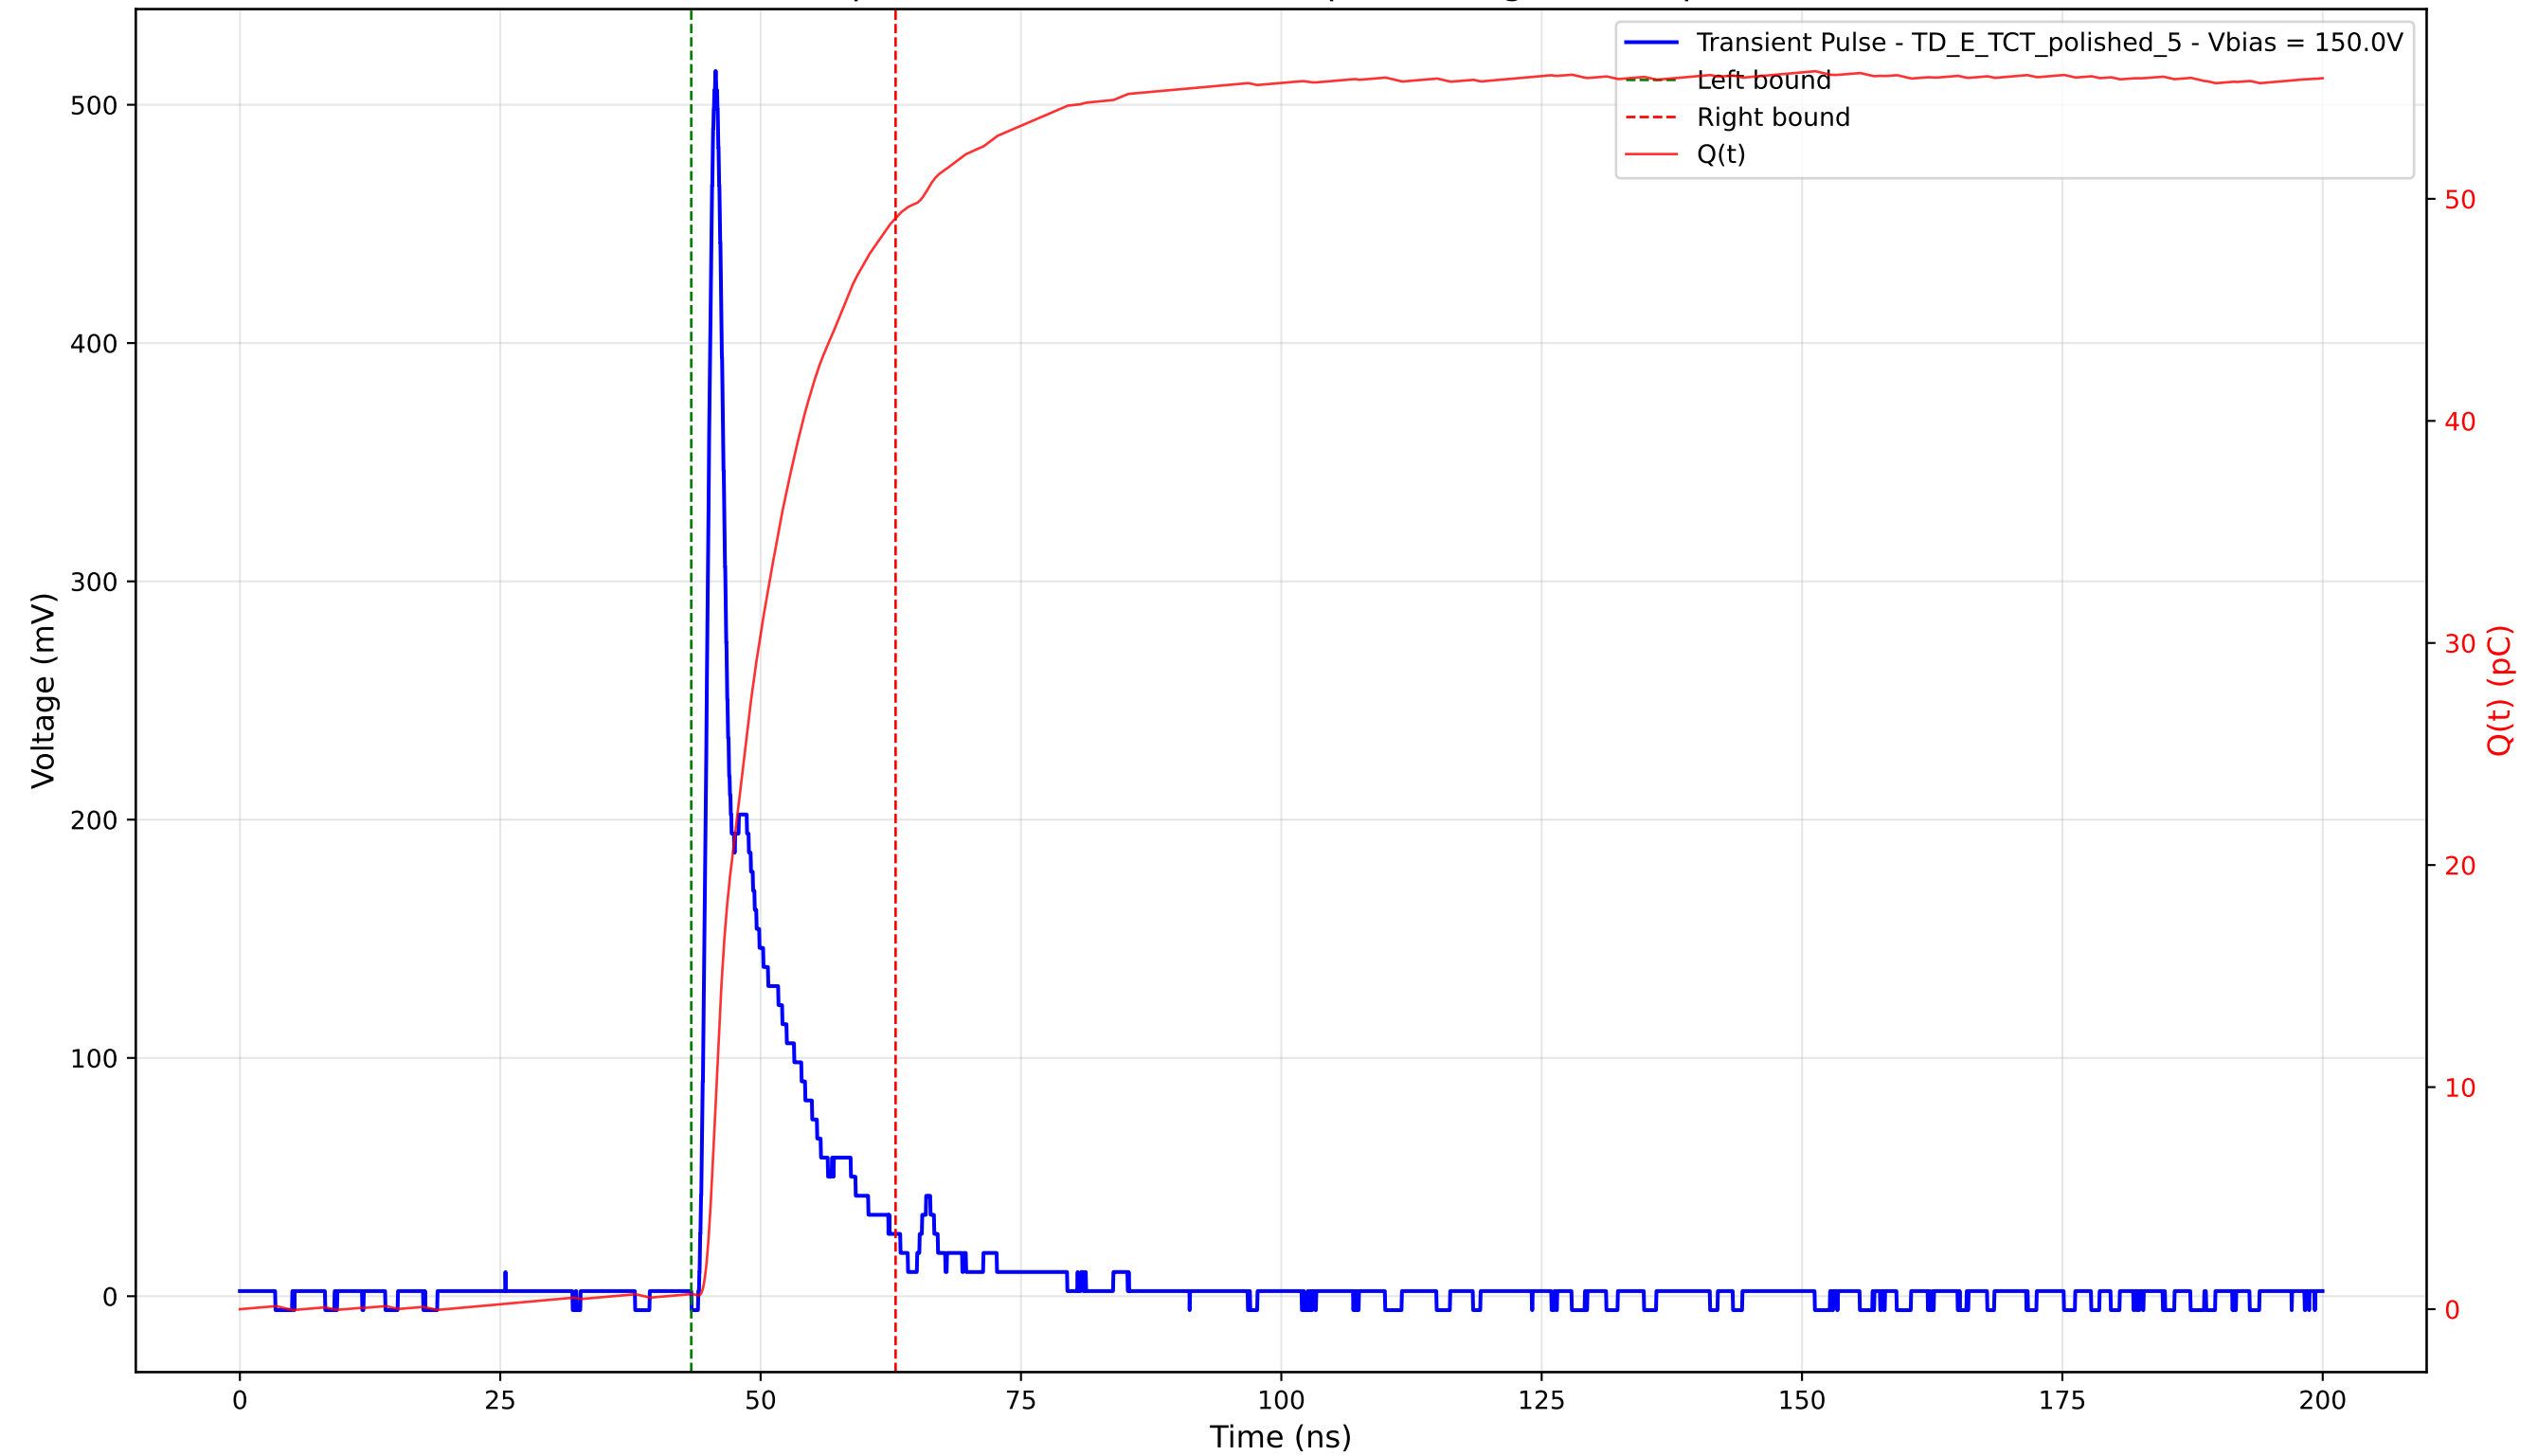


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 47.97 pC - Rise Time: 1.02 ns

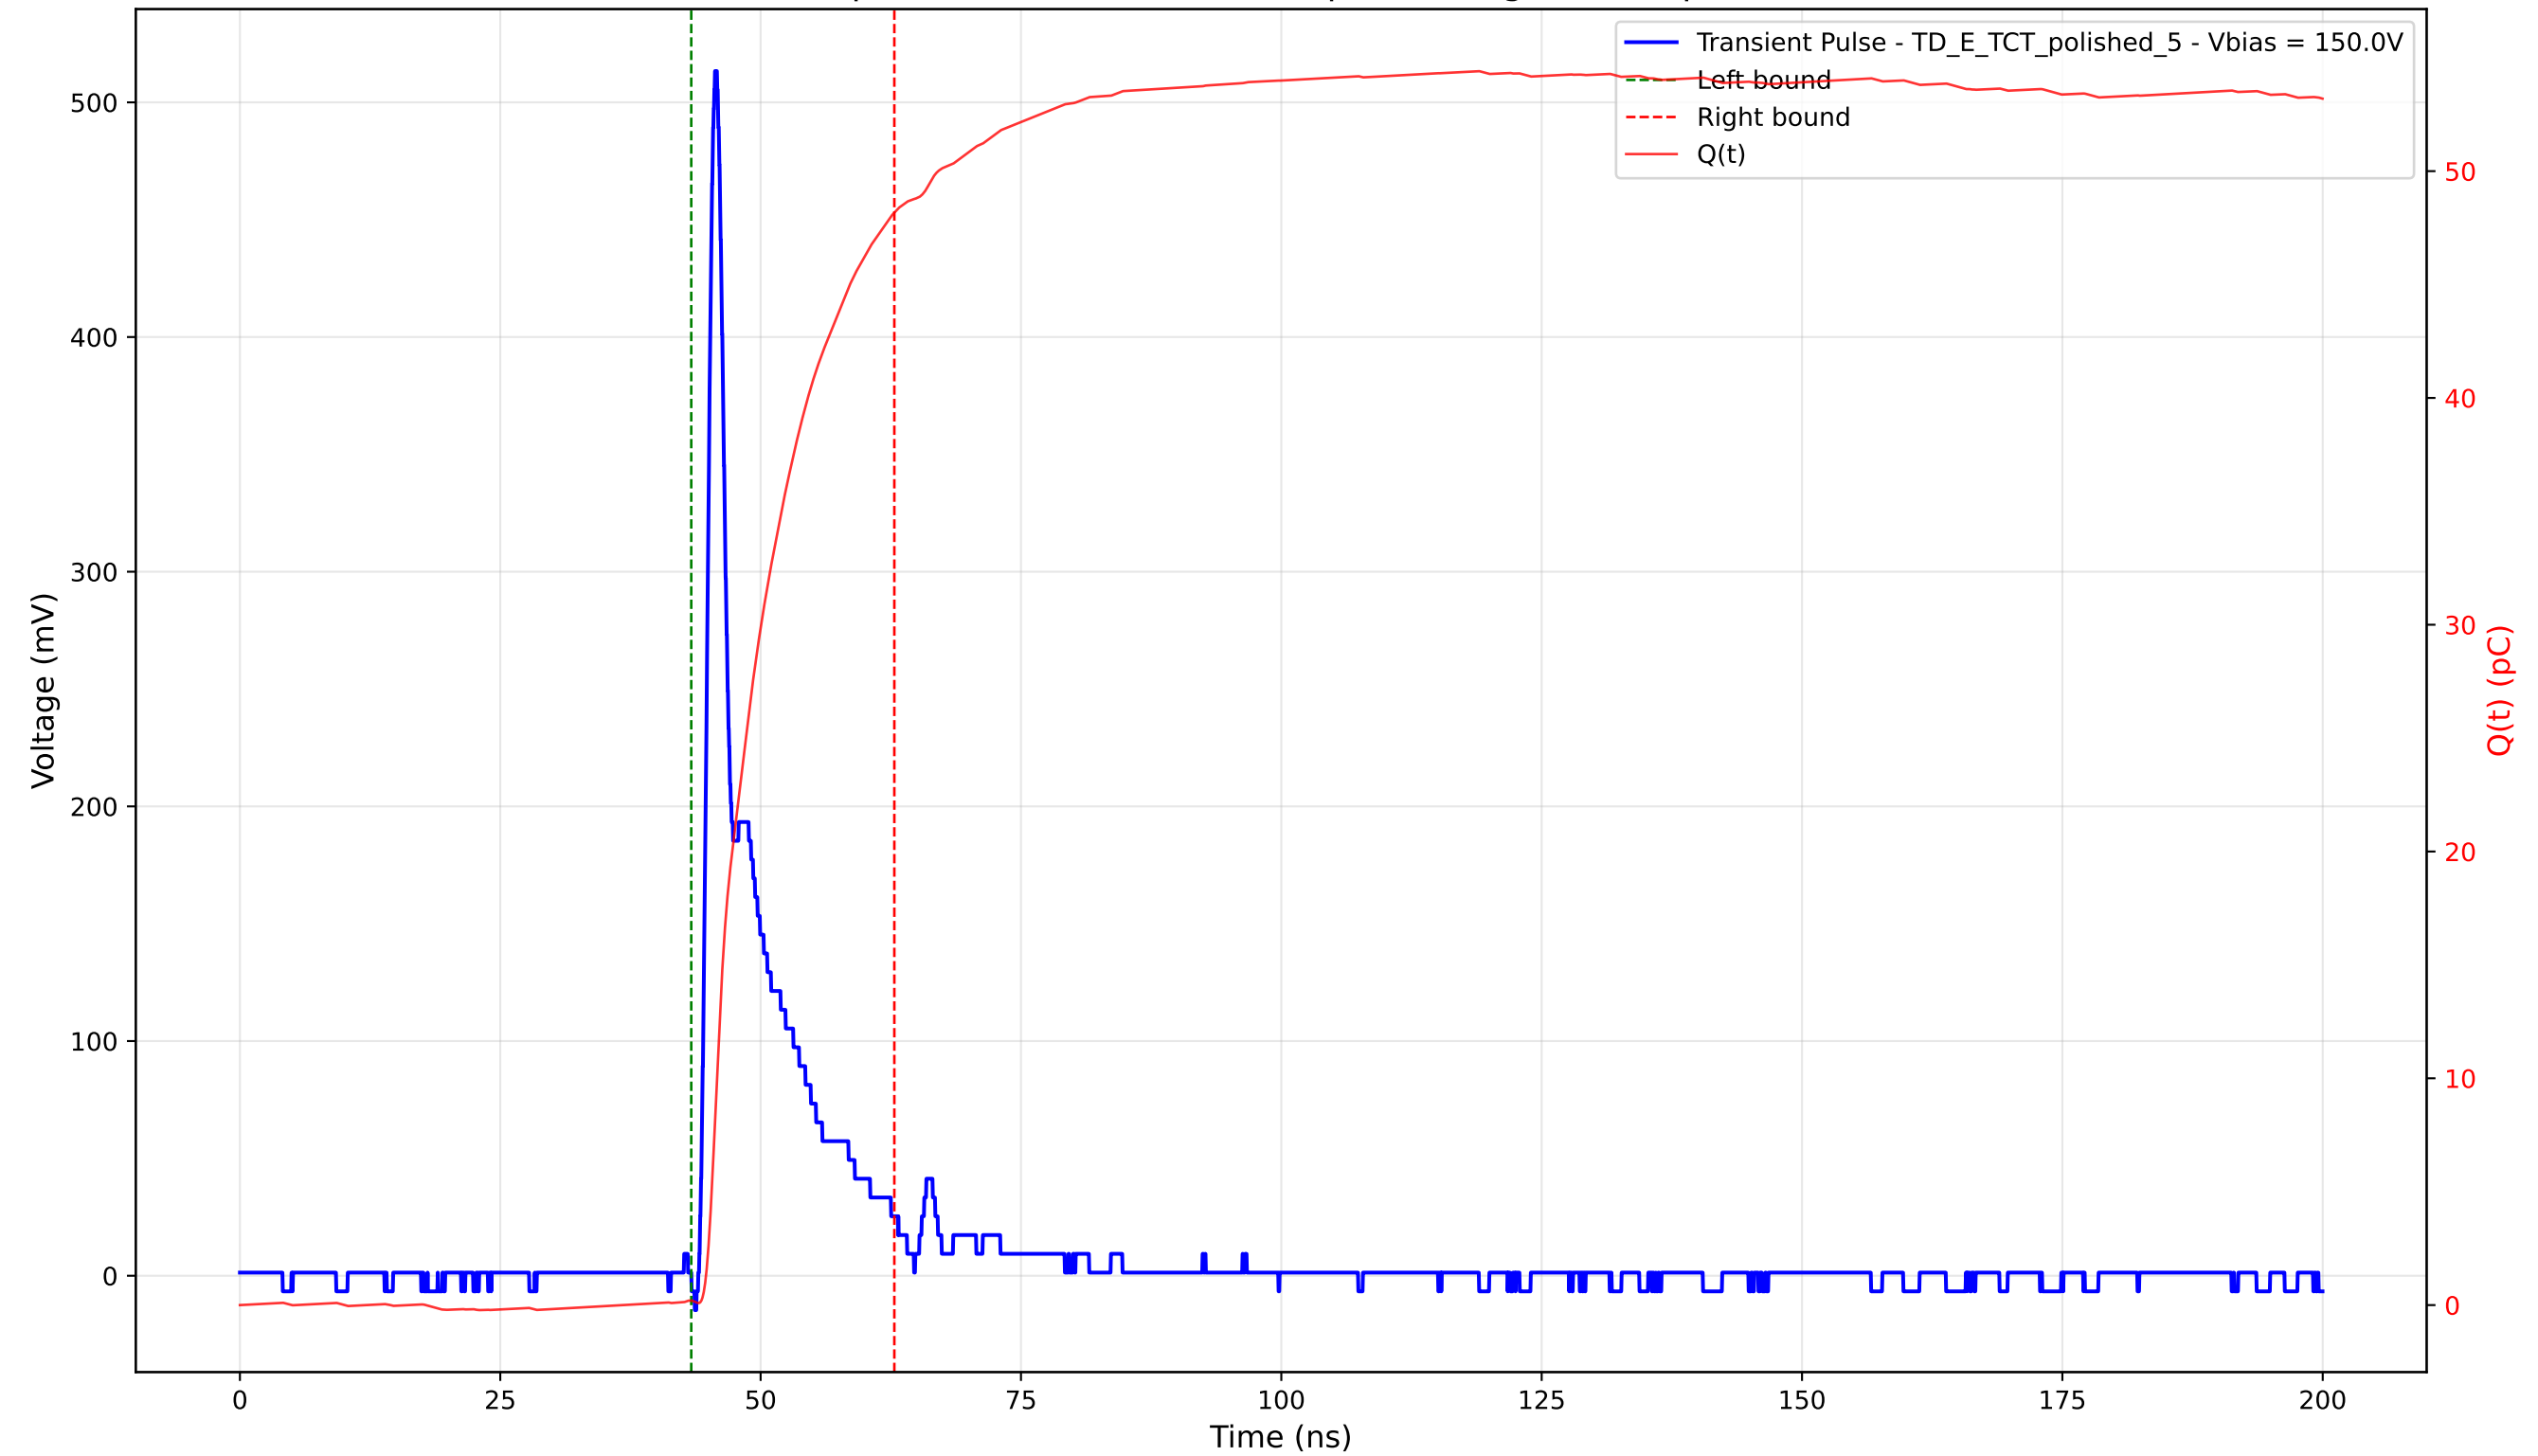


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 47.66 pC - Rise Time: 1.01 ns

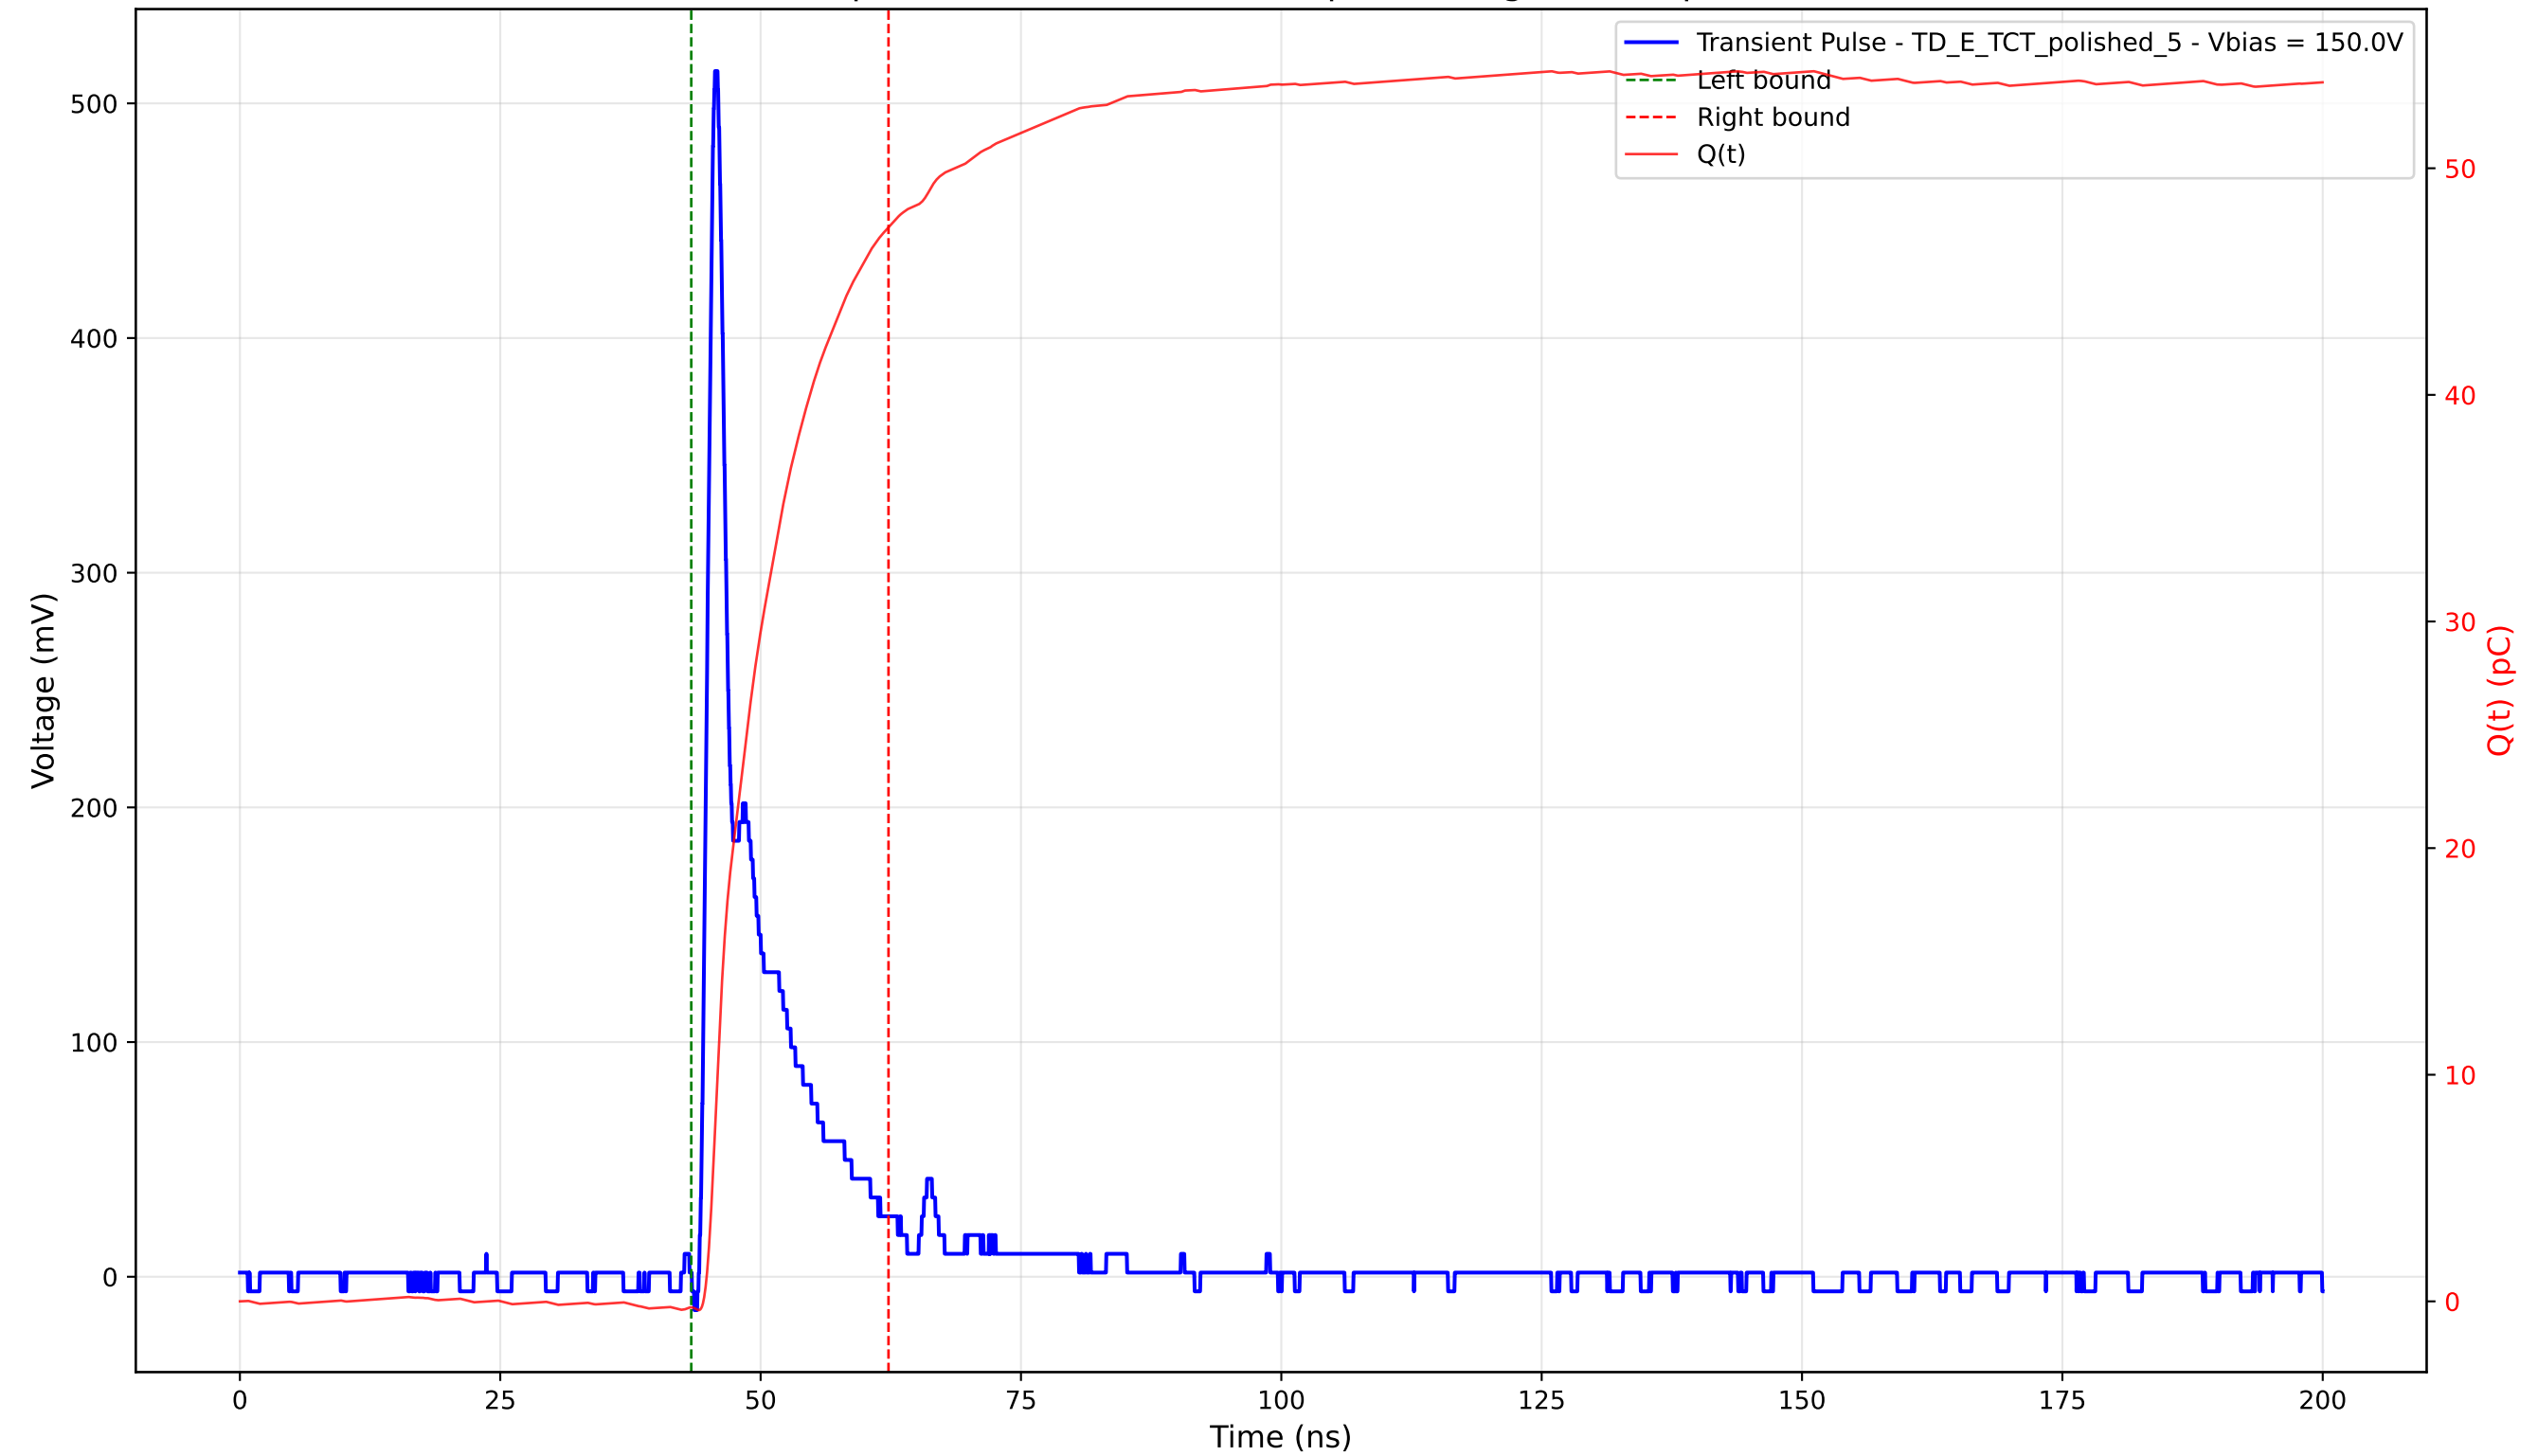


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 48.09 pC - Rise Time: 1.05 ns

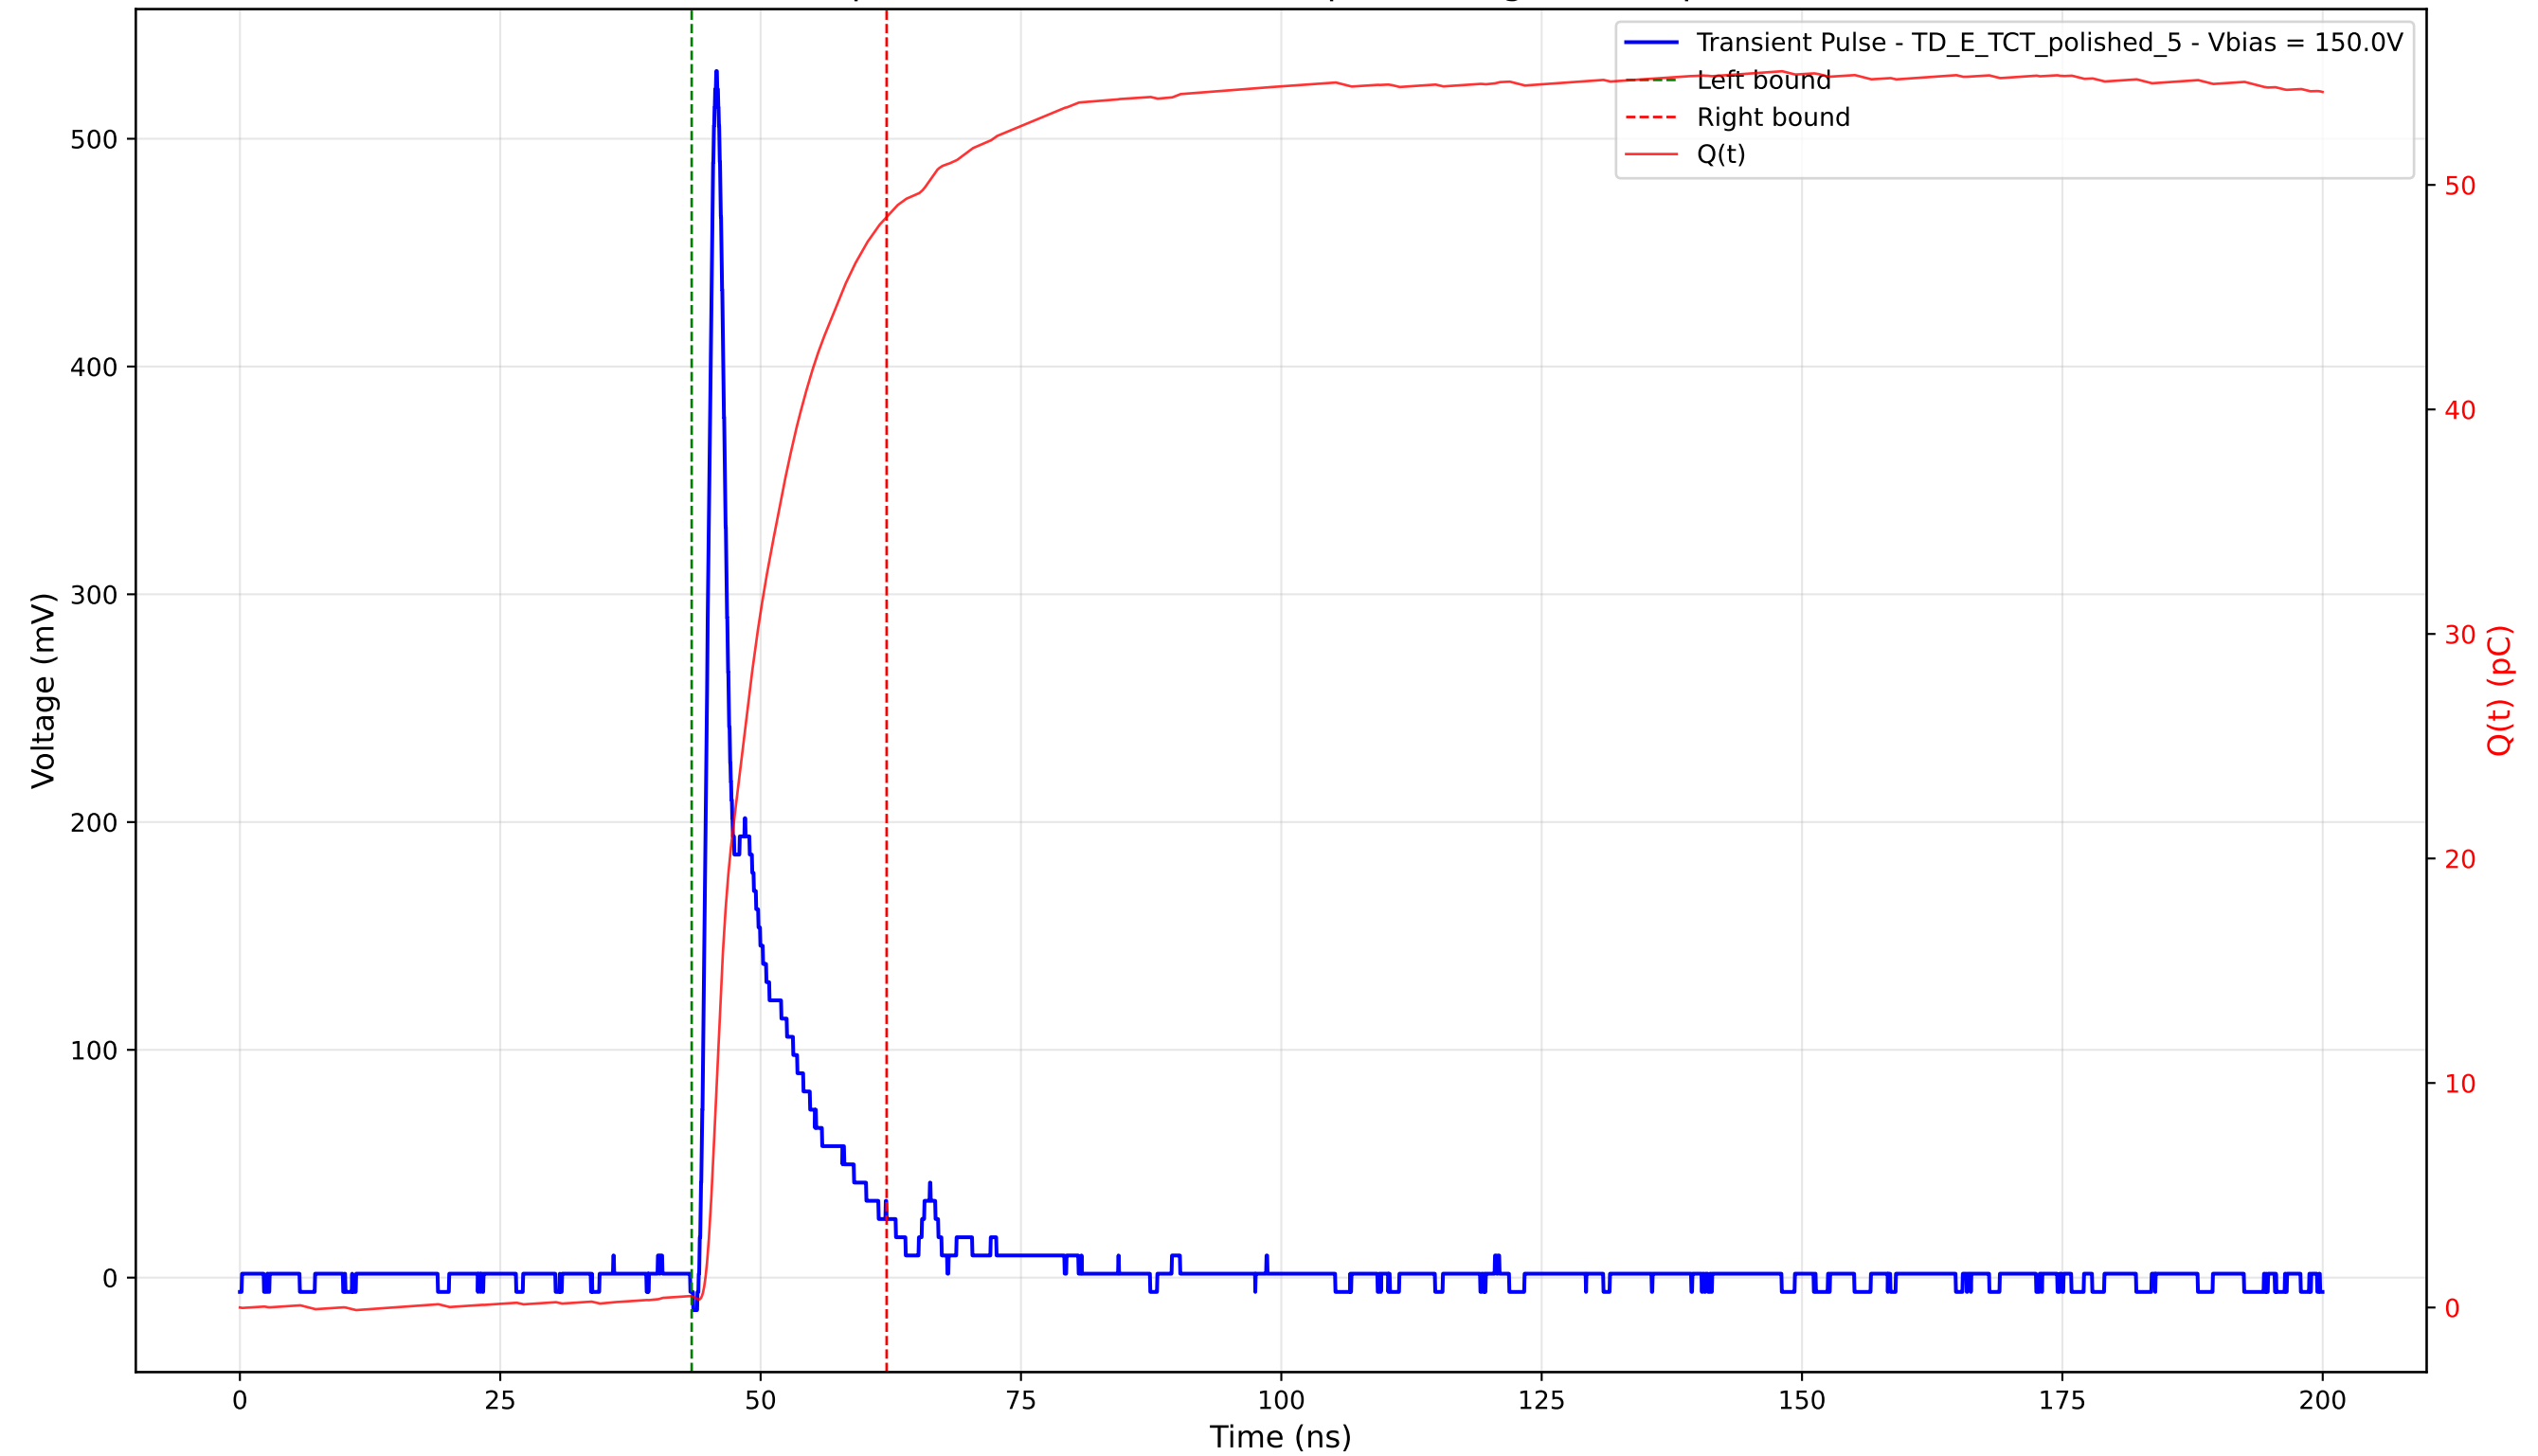


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 47.29 pC - Rise Time: 1.07 ns

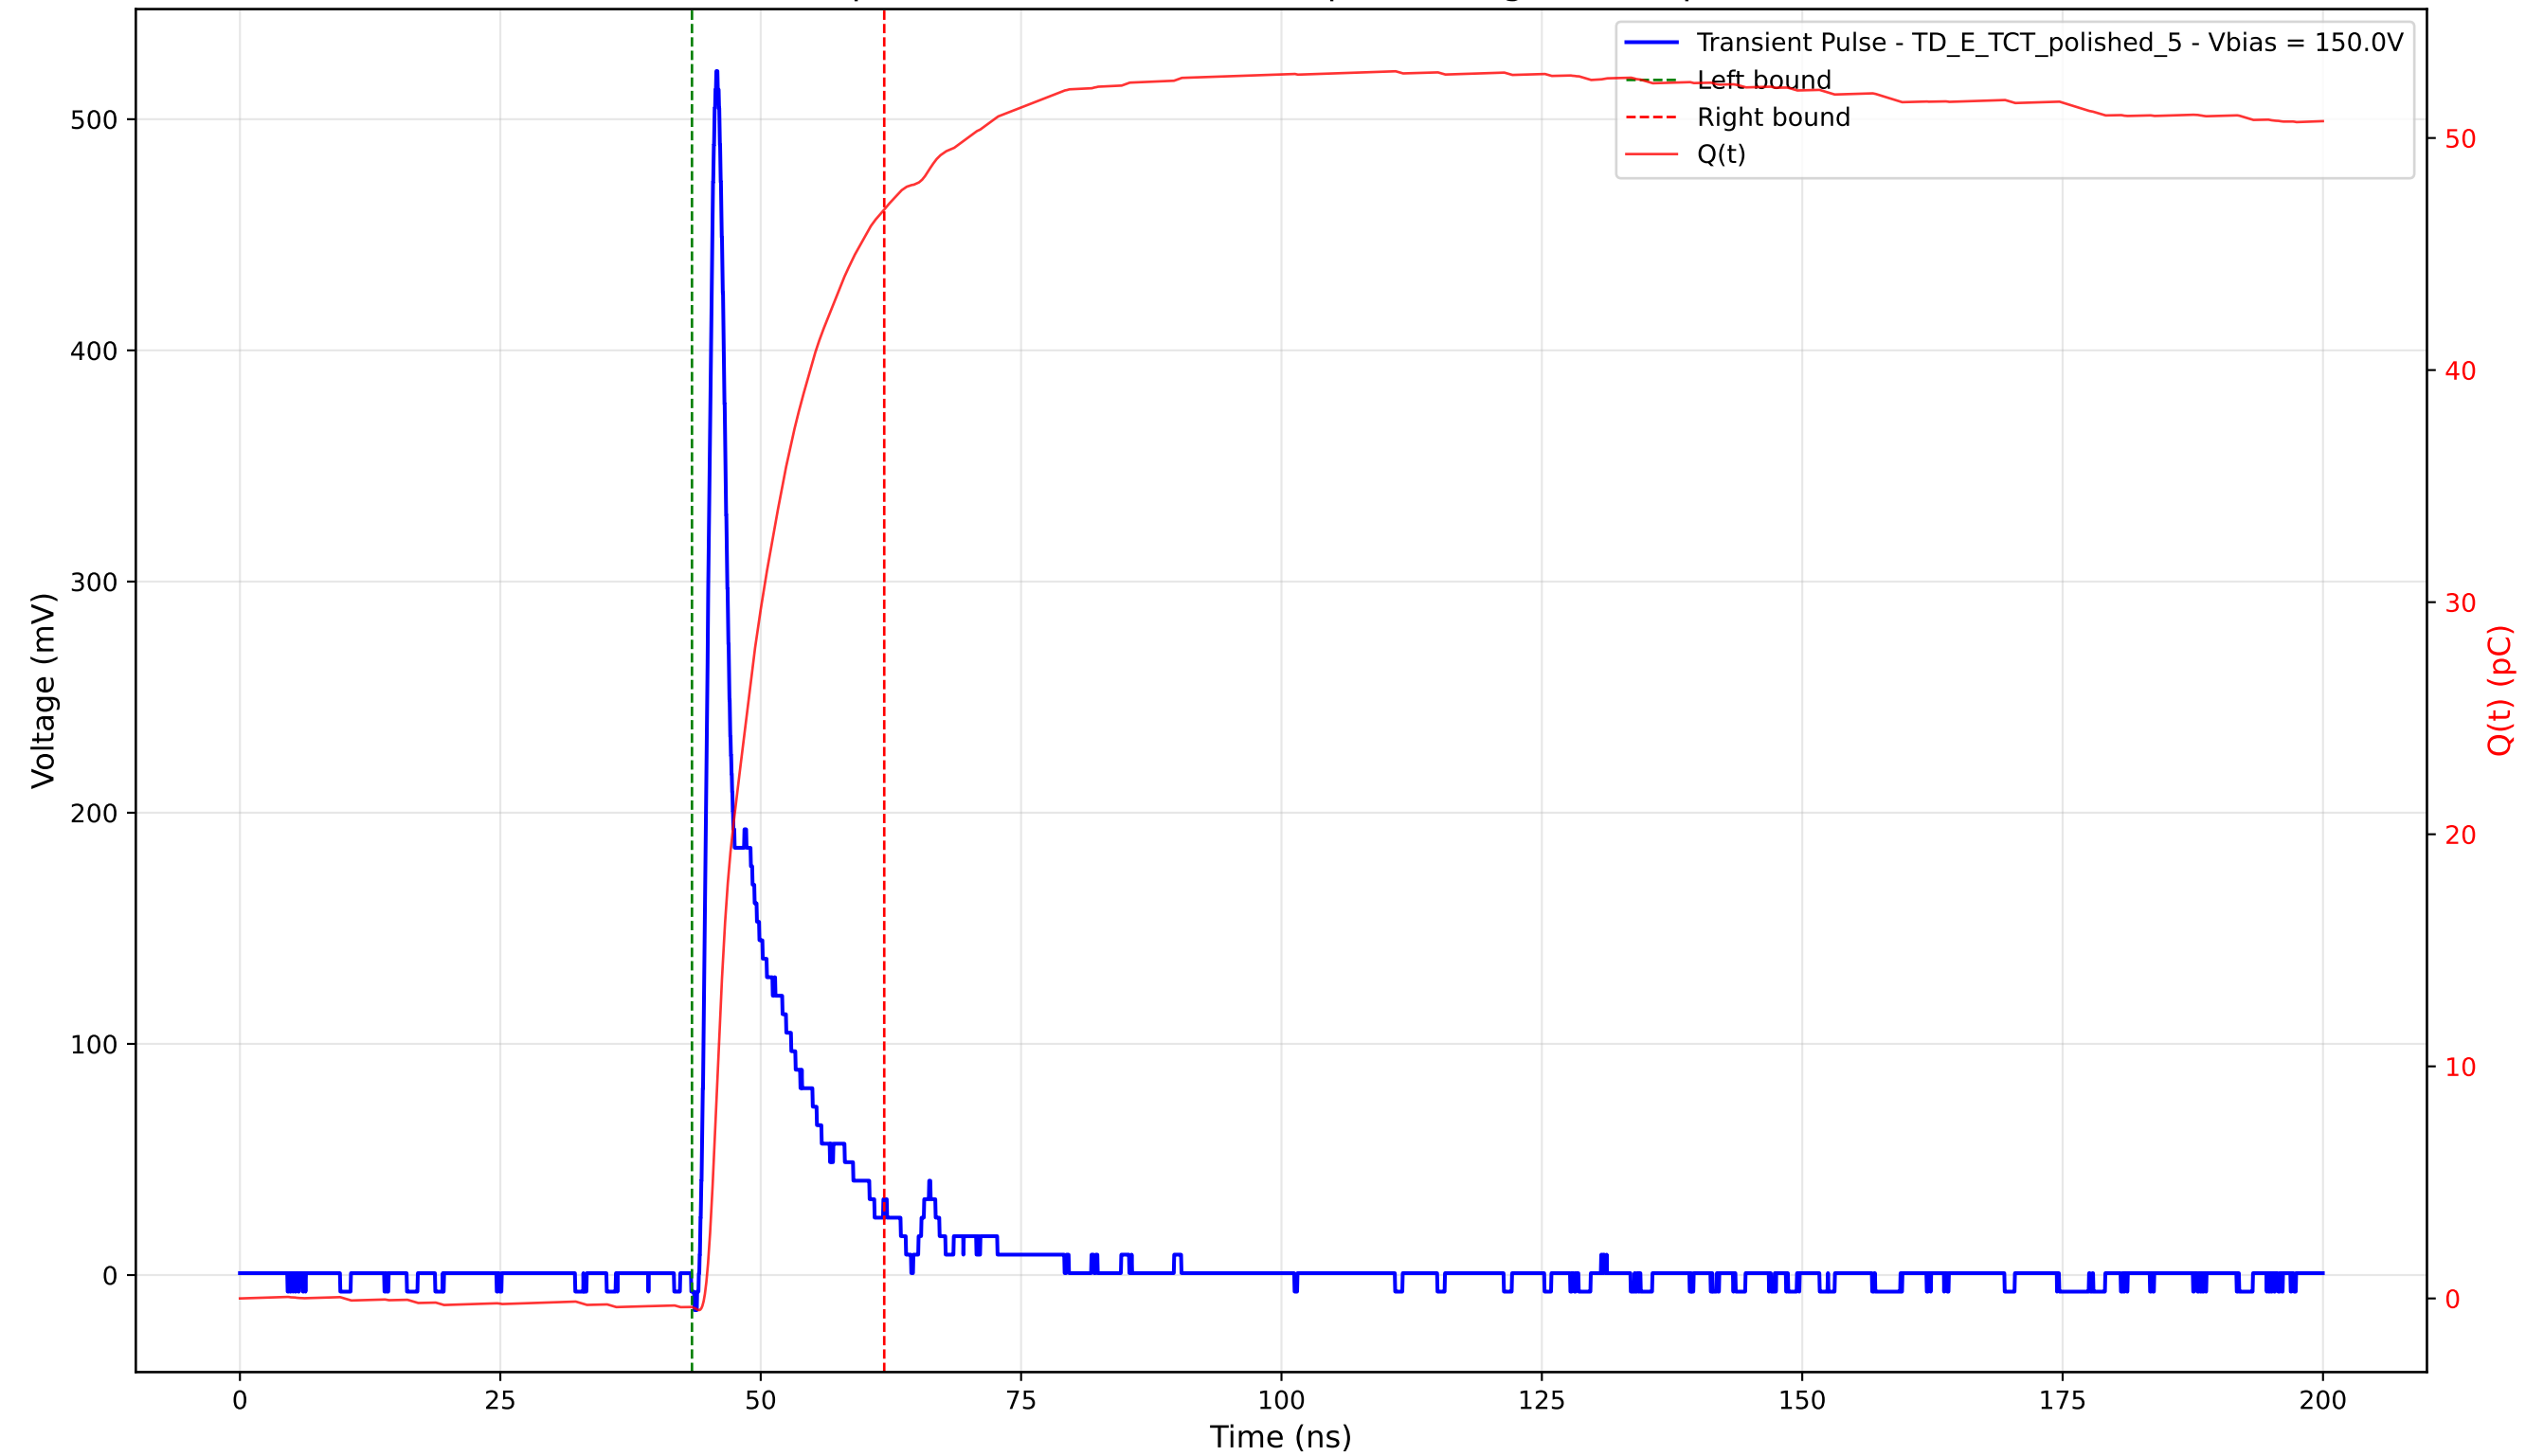


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 48.06 pC - Rise Time: 1.10 ns

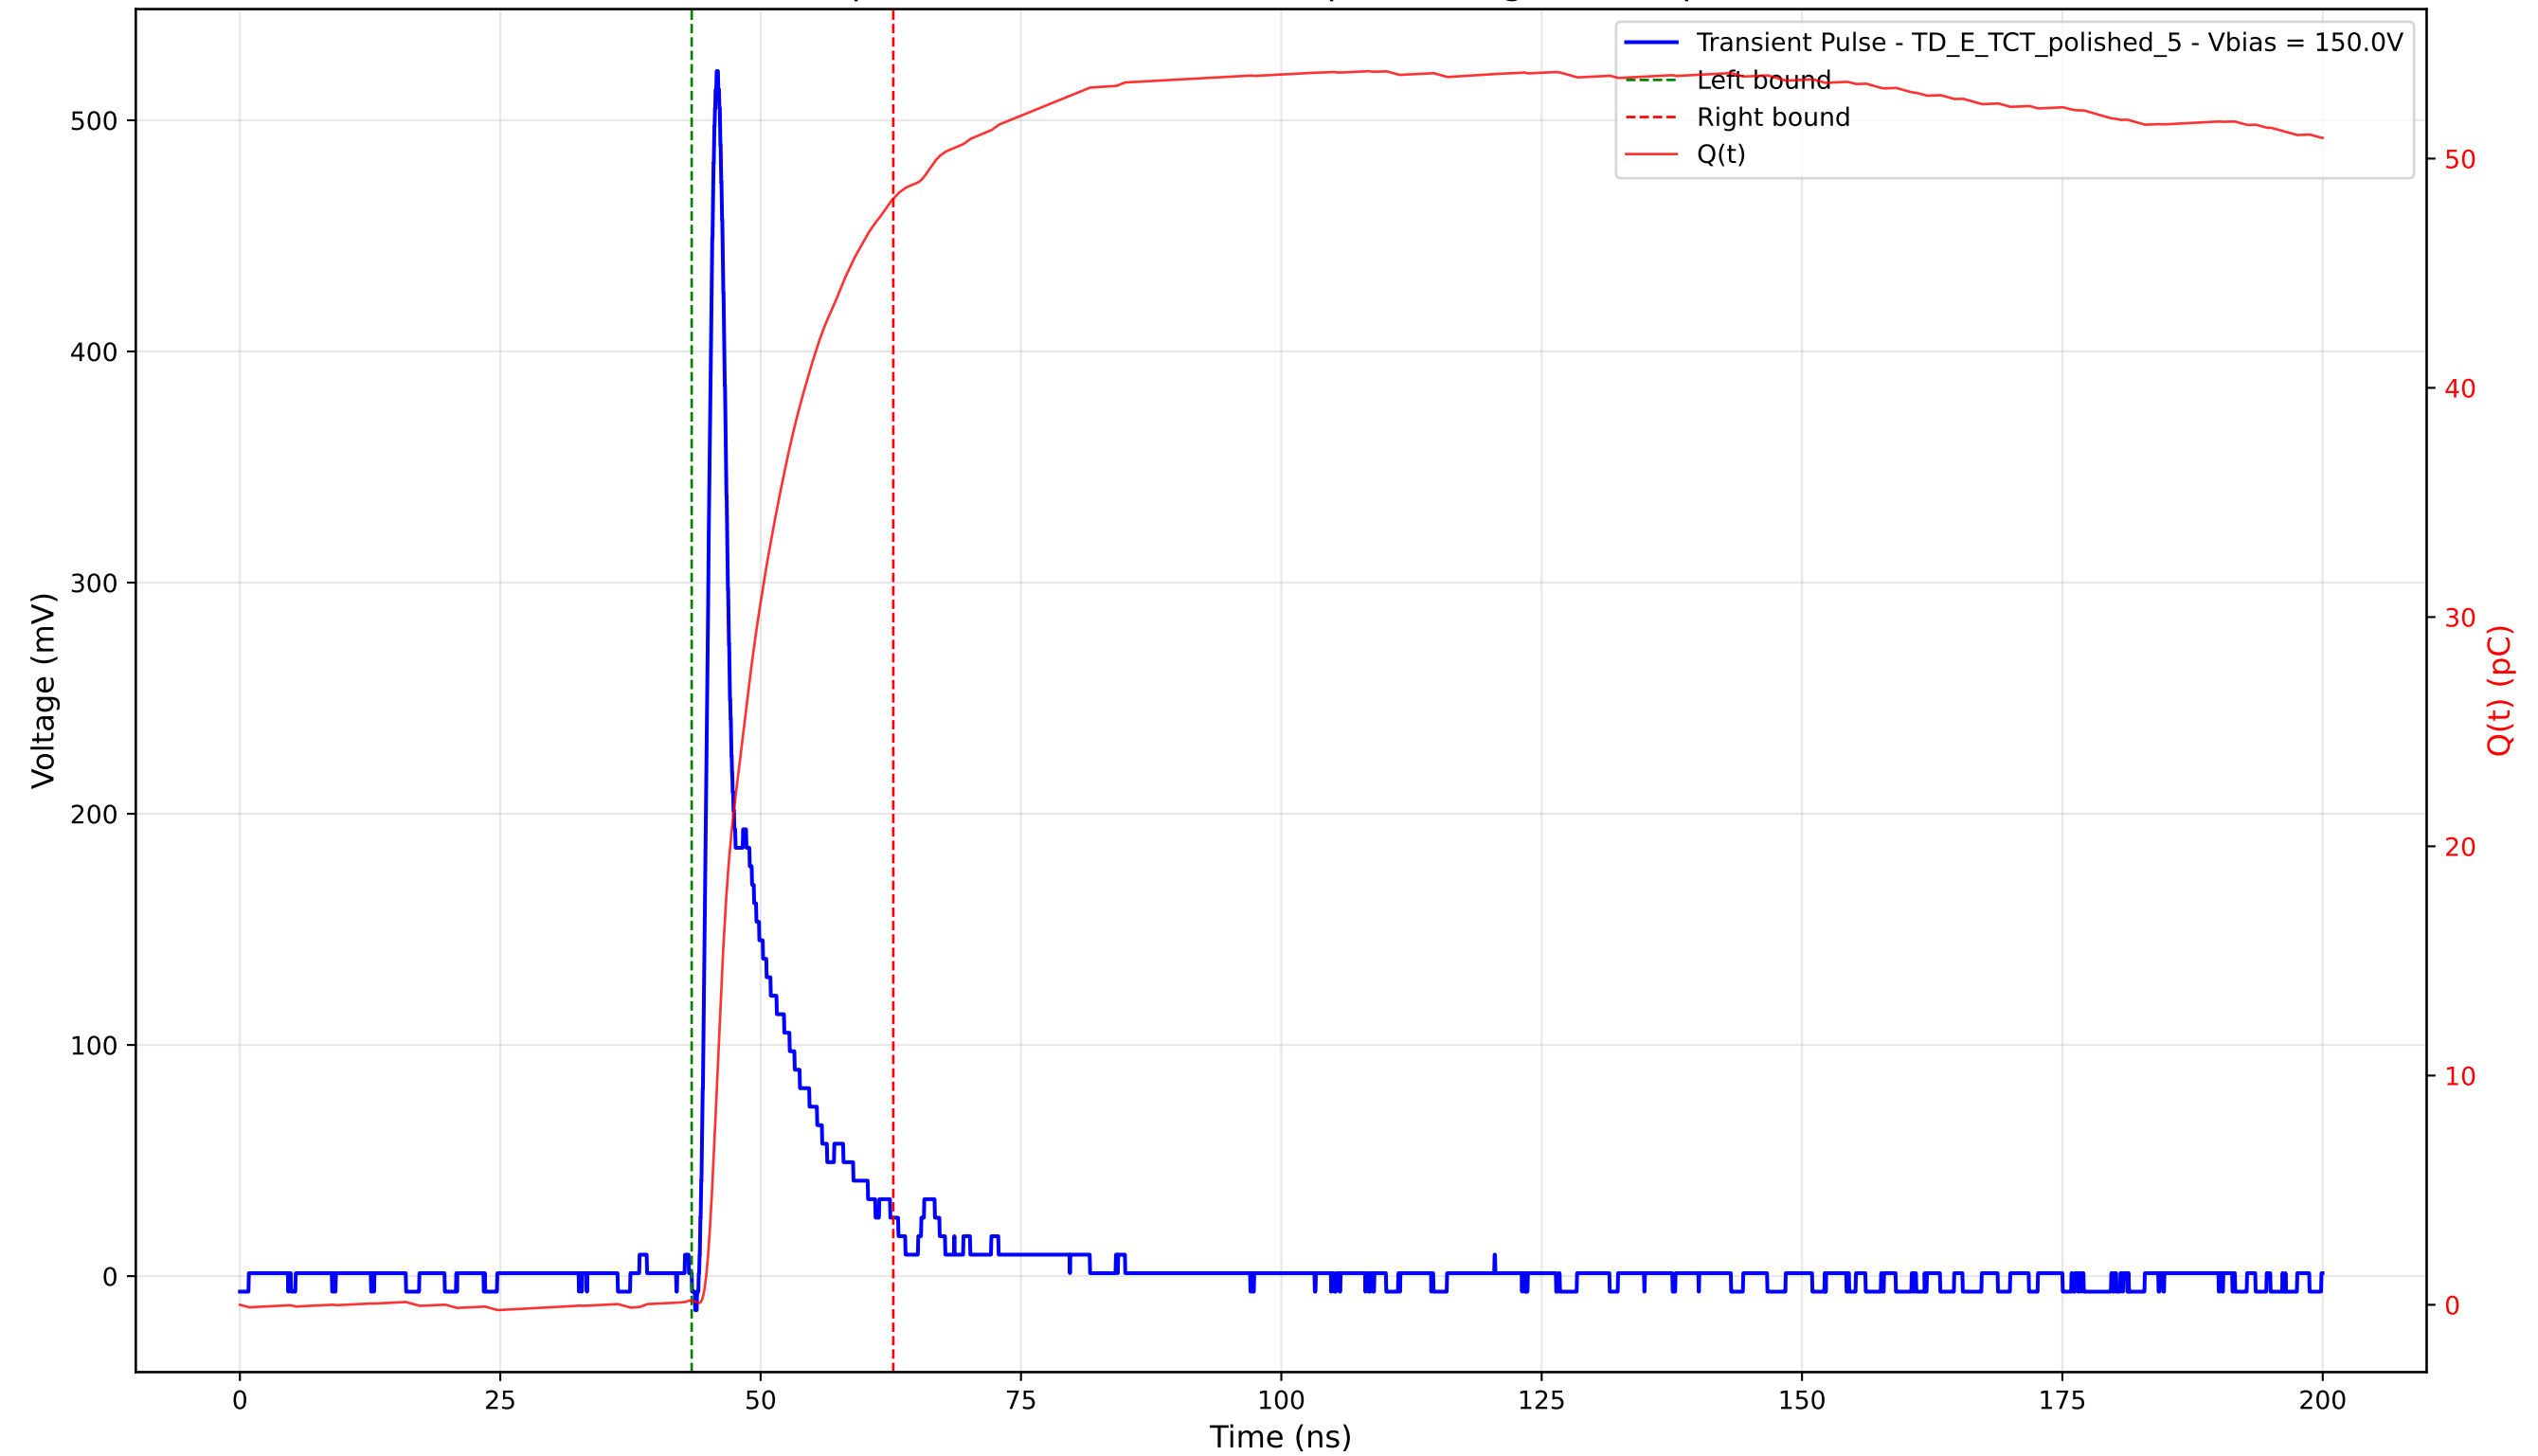


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 47.53 pC - Rise Time: 1.11 ns

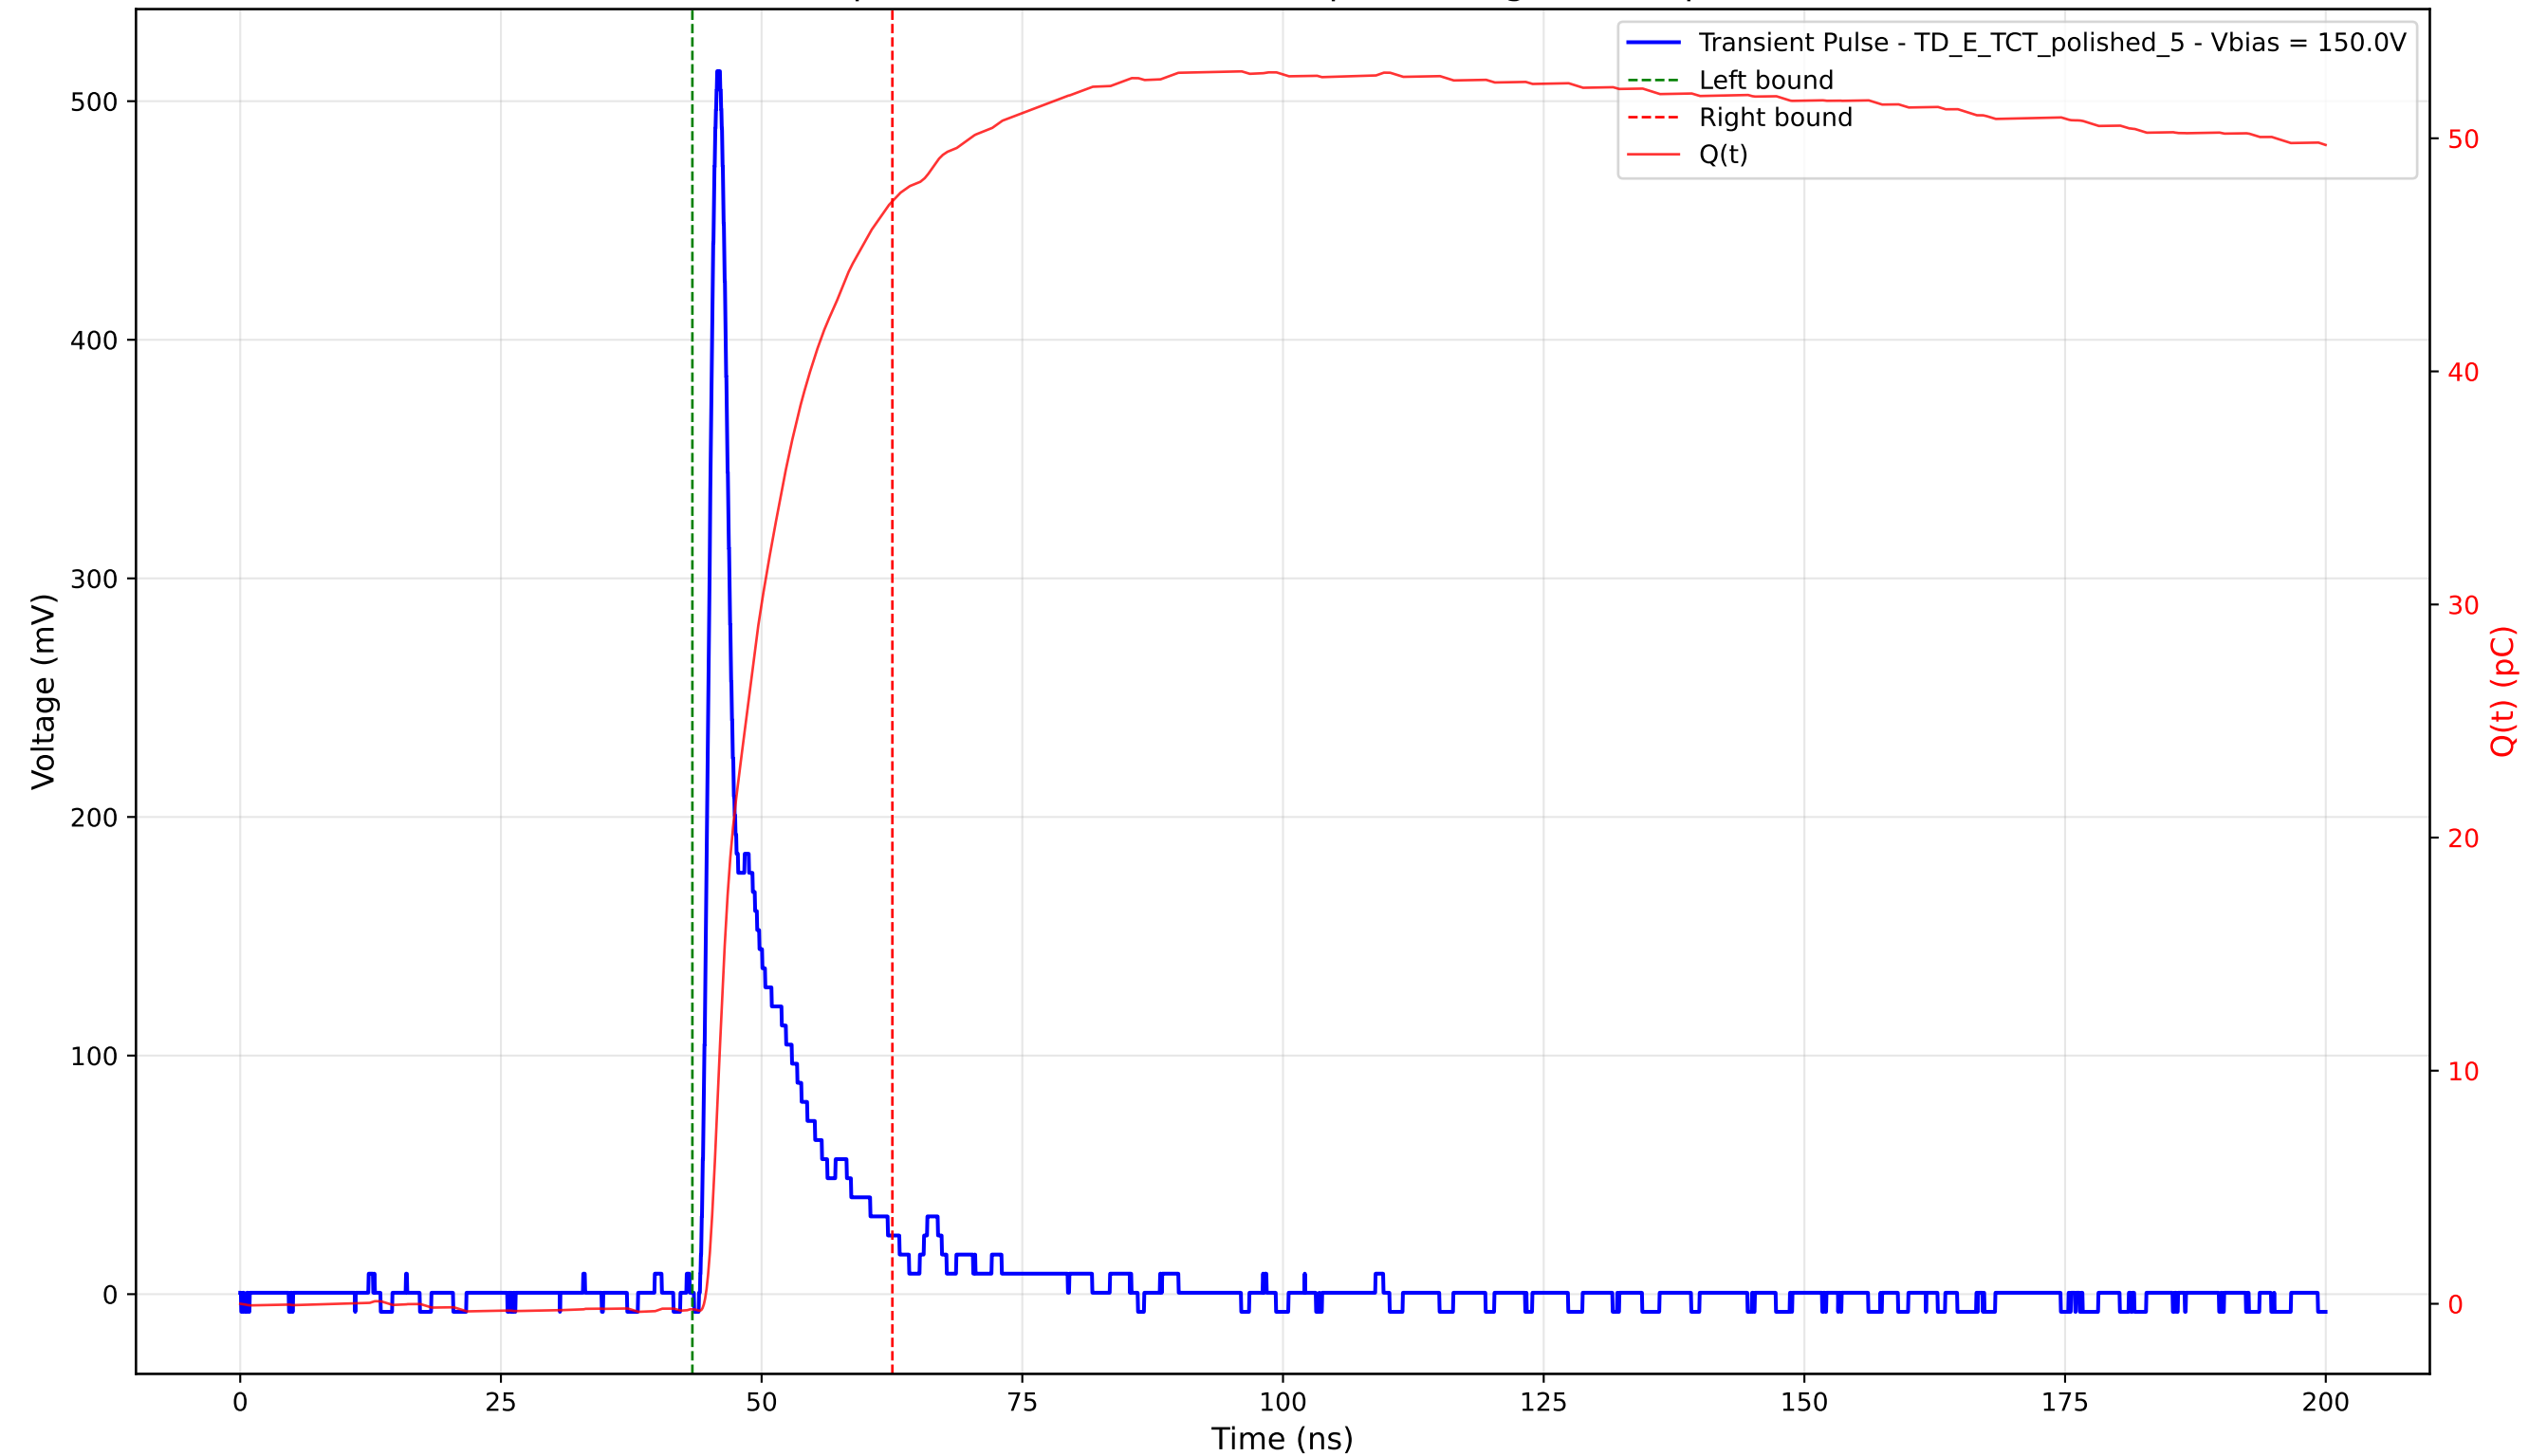


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 47.19 pC - Rise Time: 1.13 ns

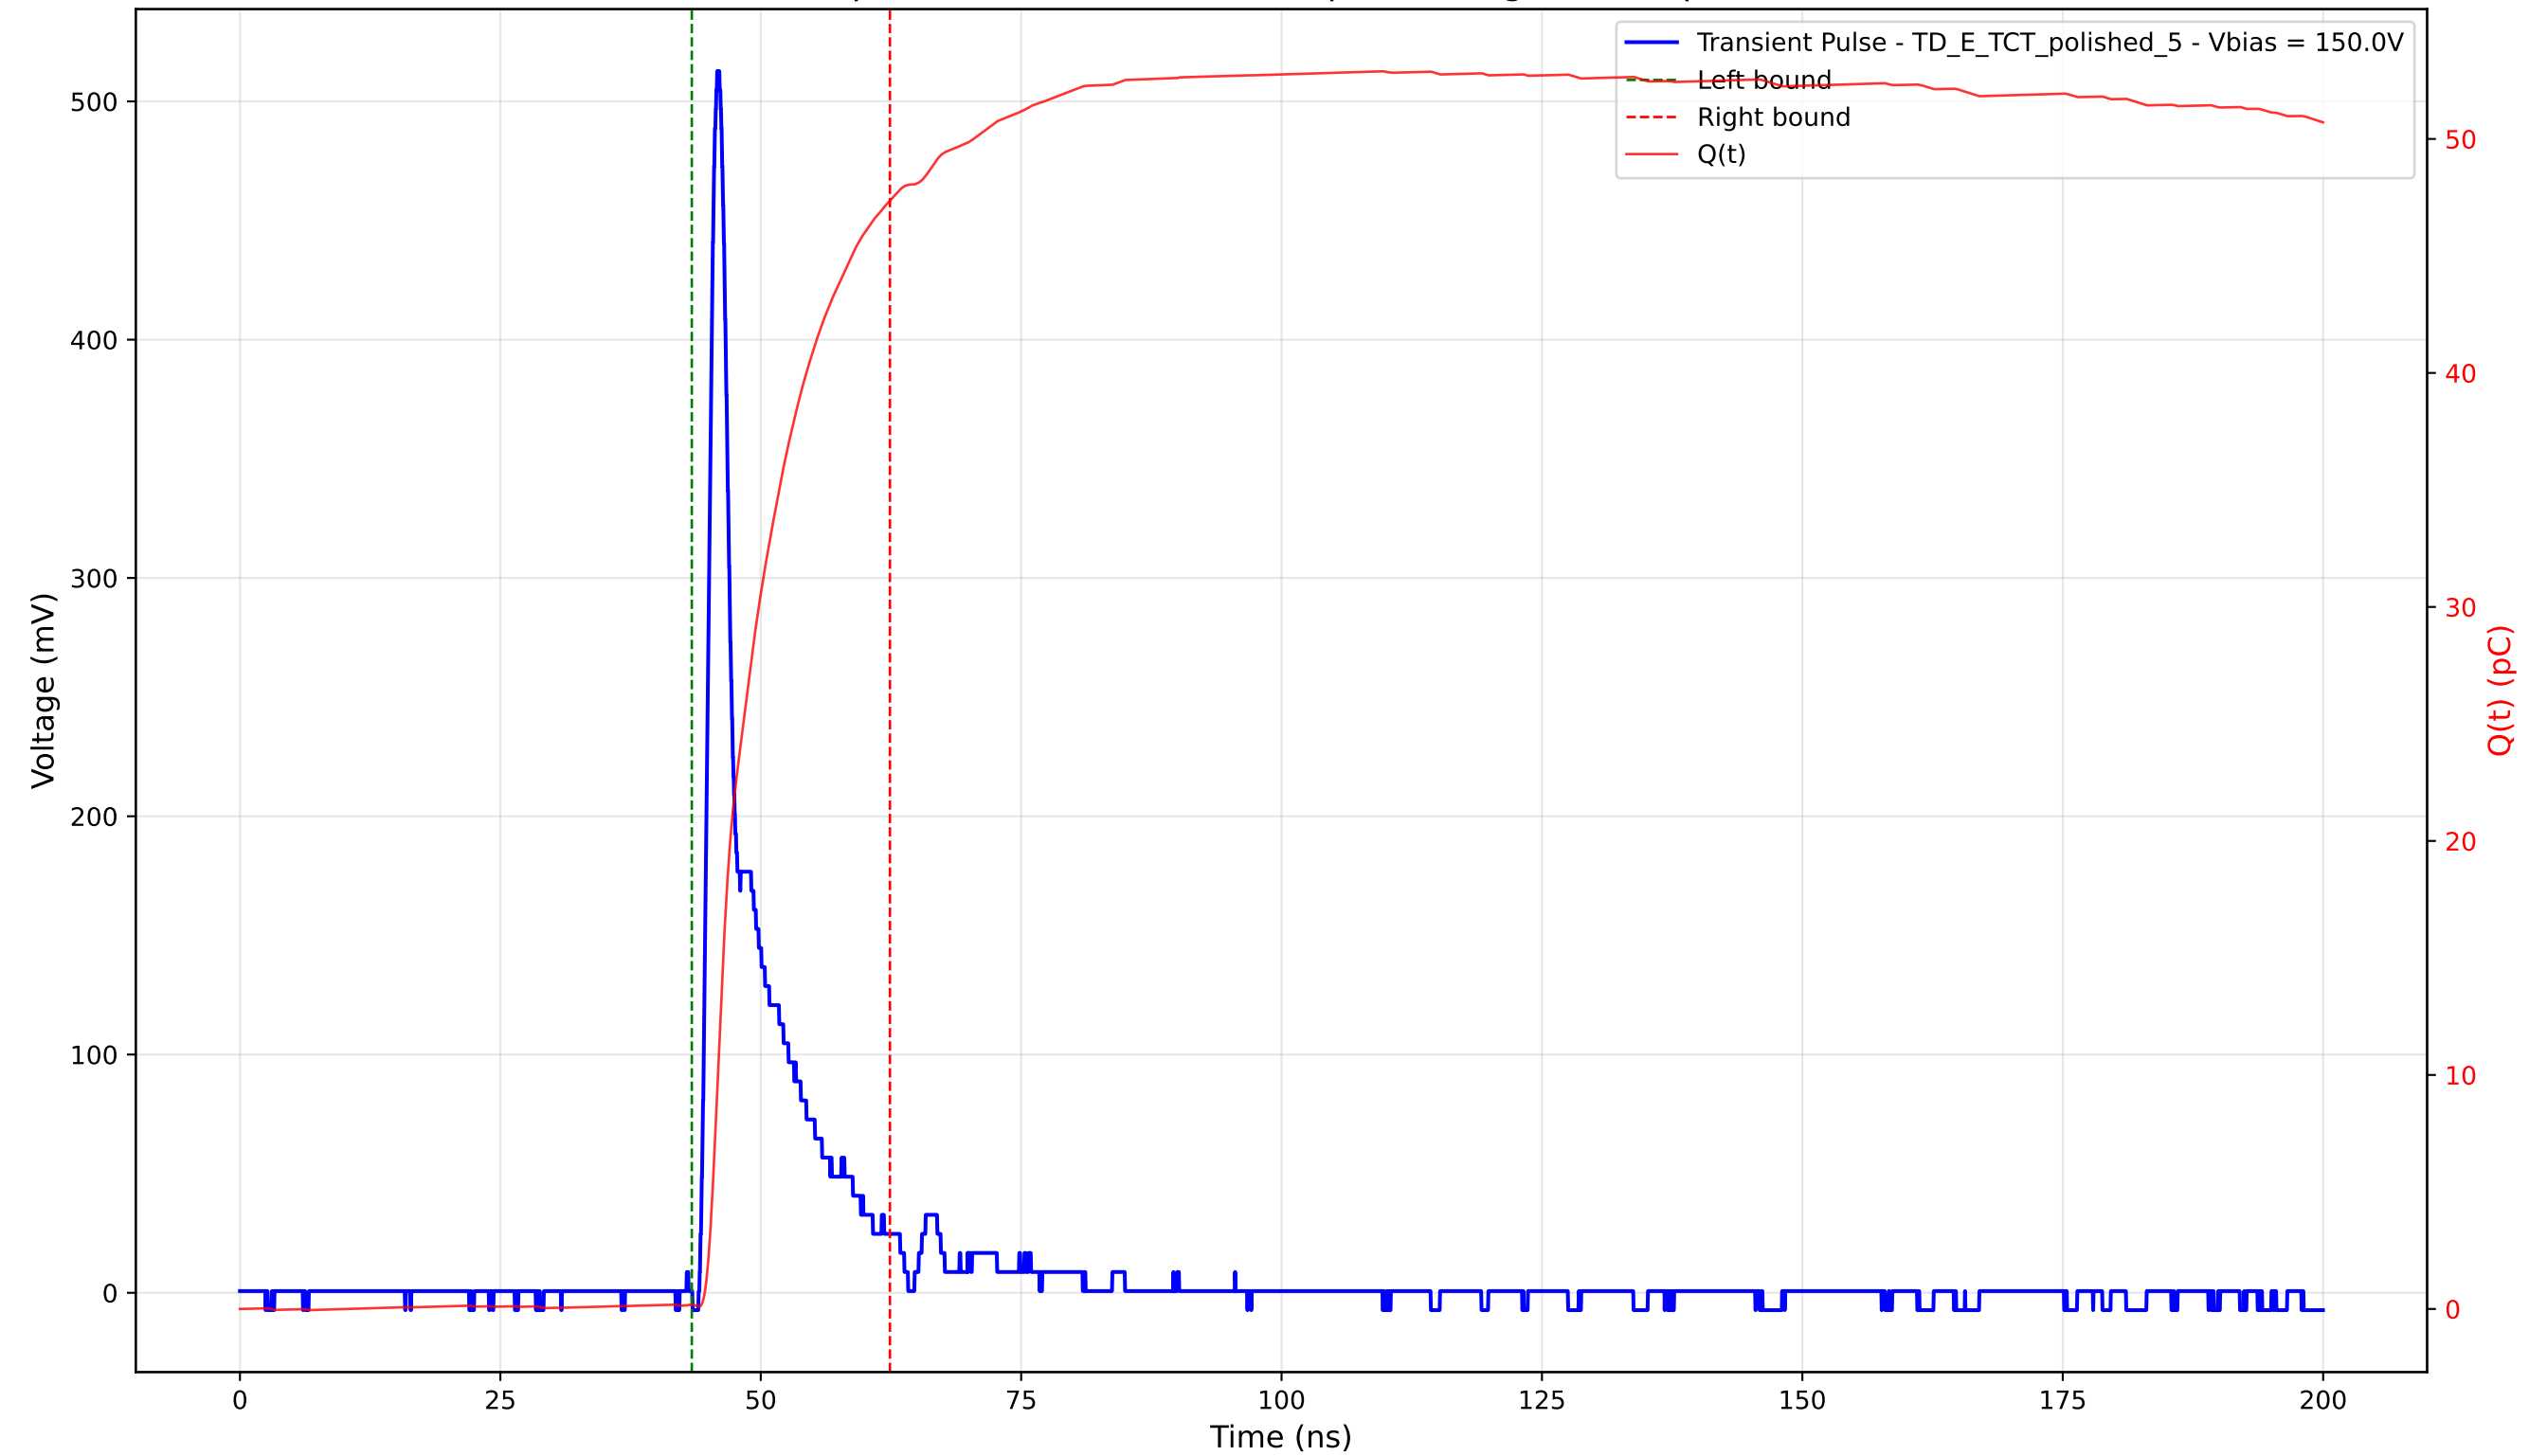


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 47.51 pC - Rise Time: 1.16 ns

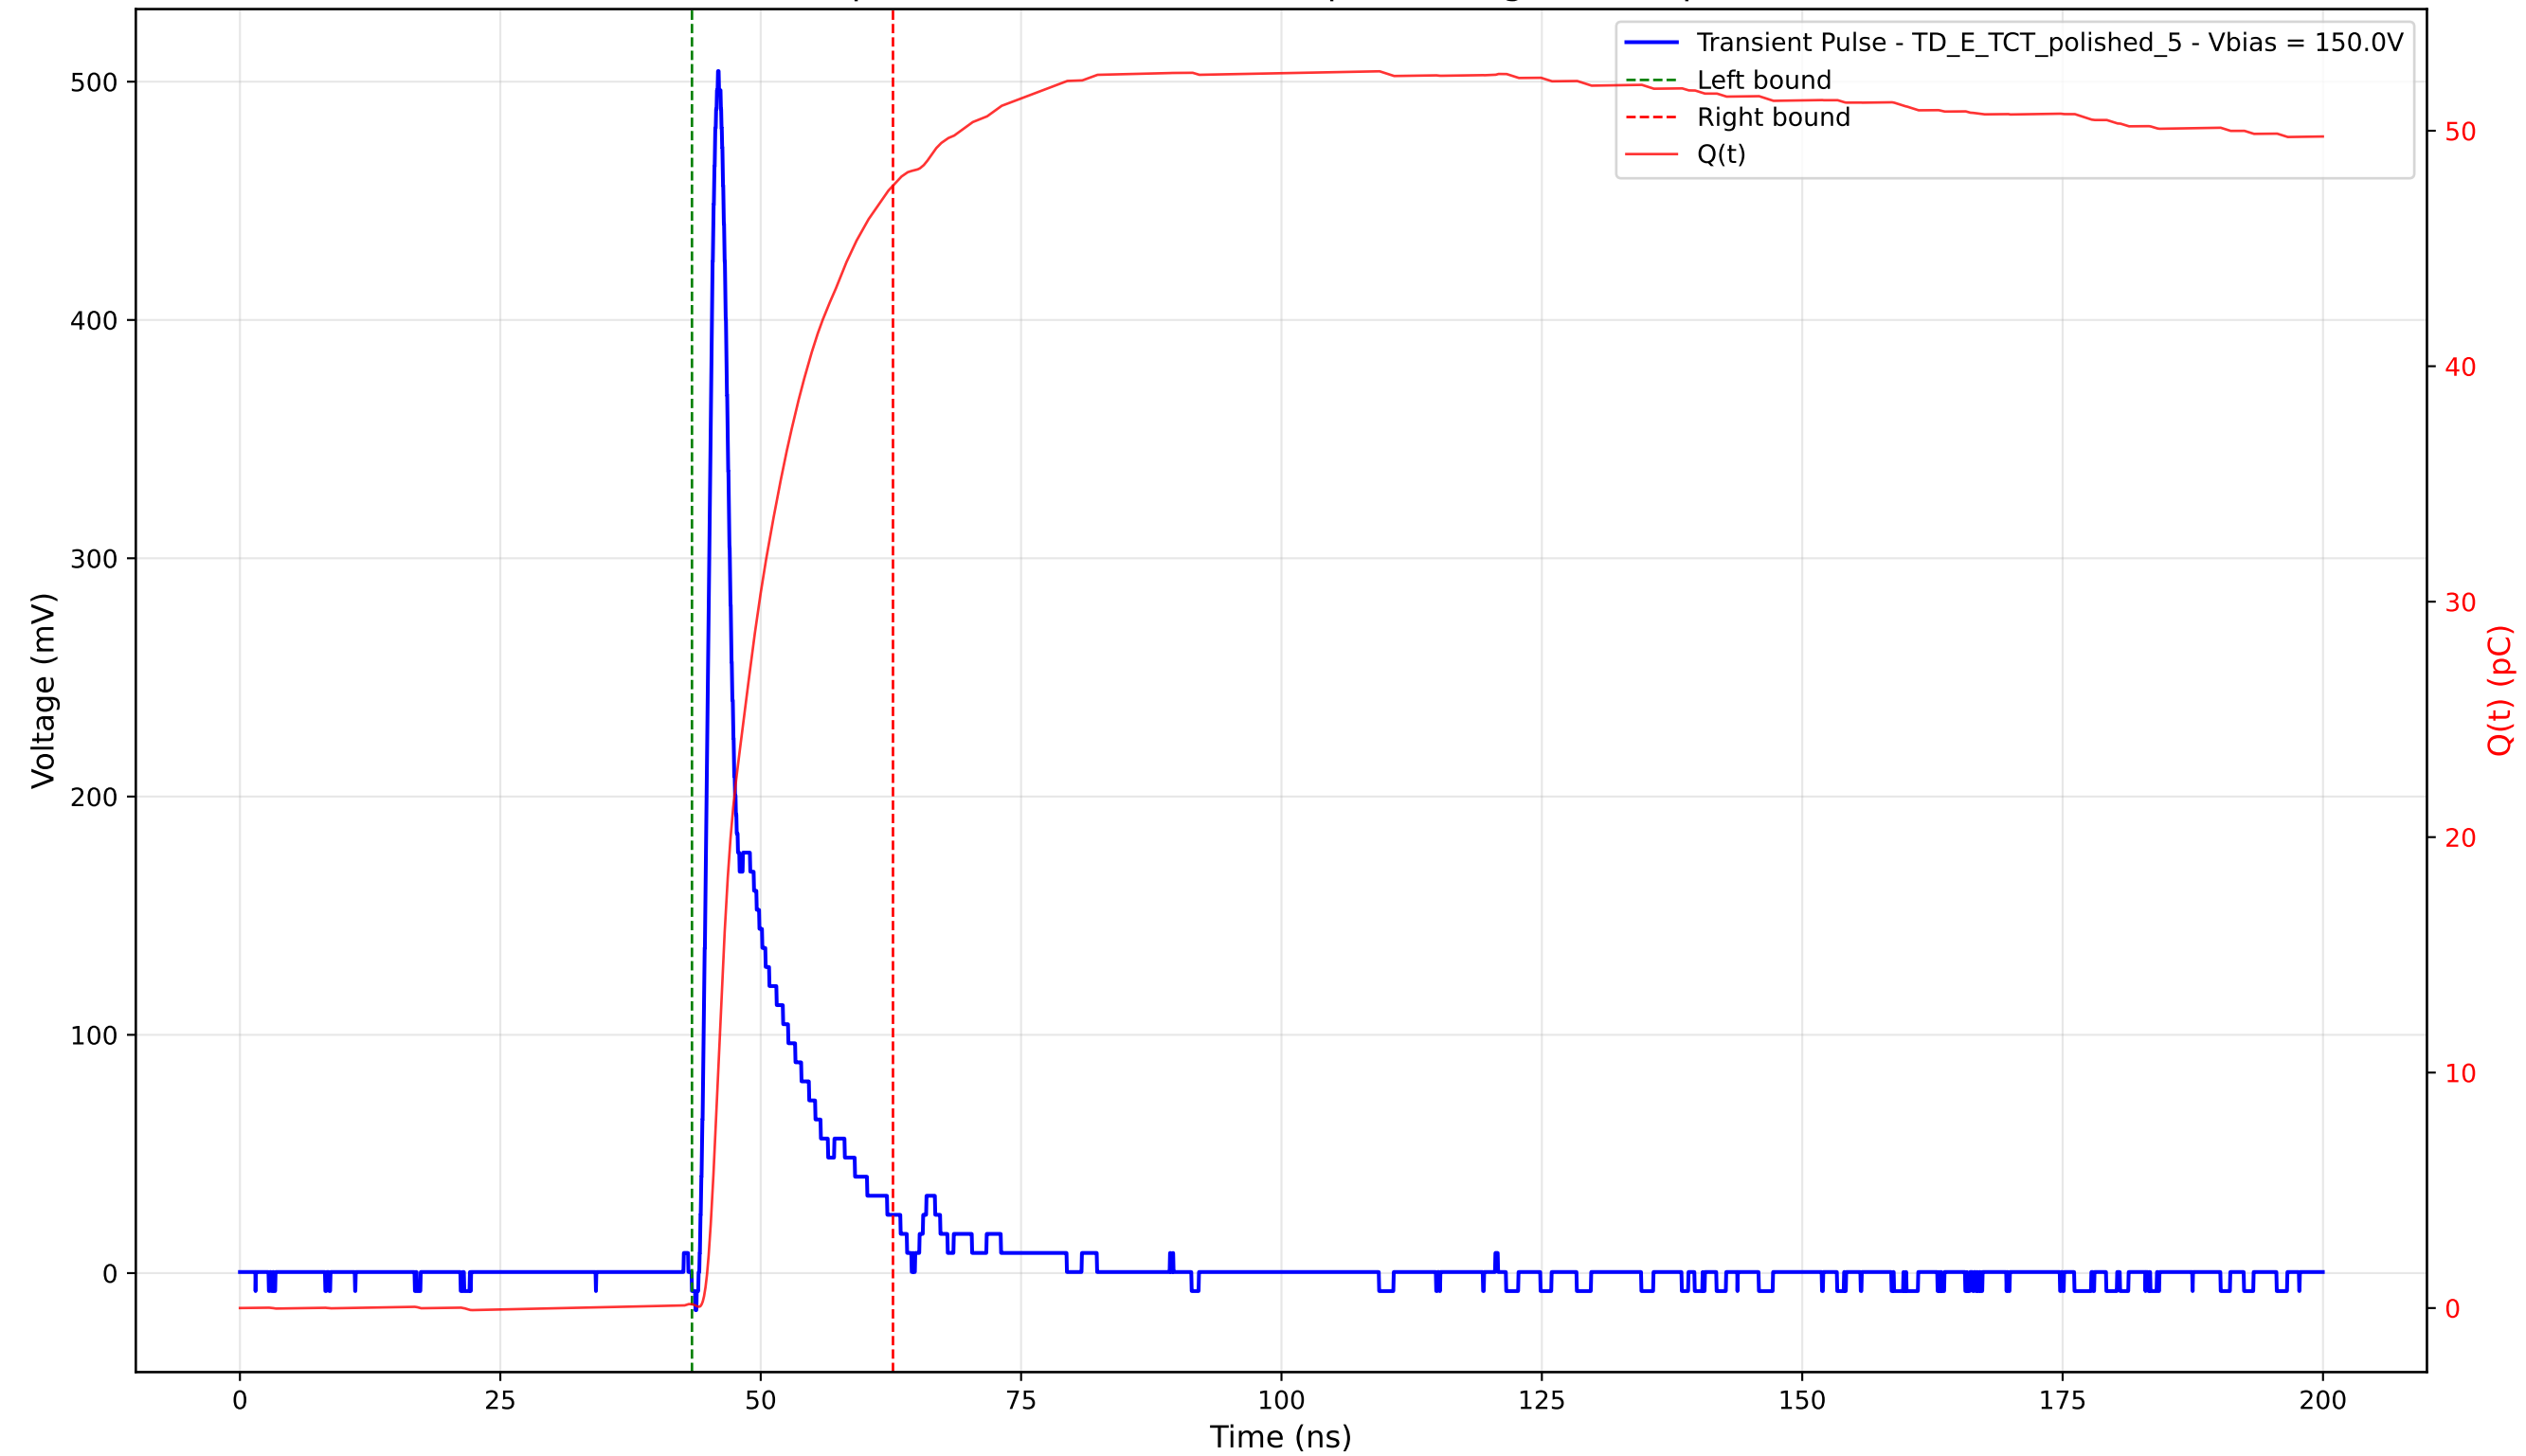


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 48.63 pC - Rise Time: 1.17 ns

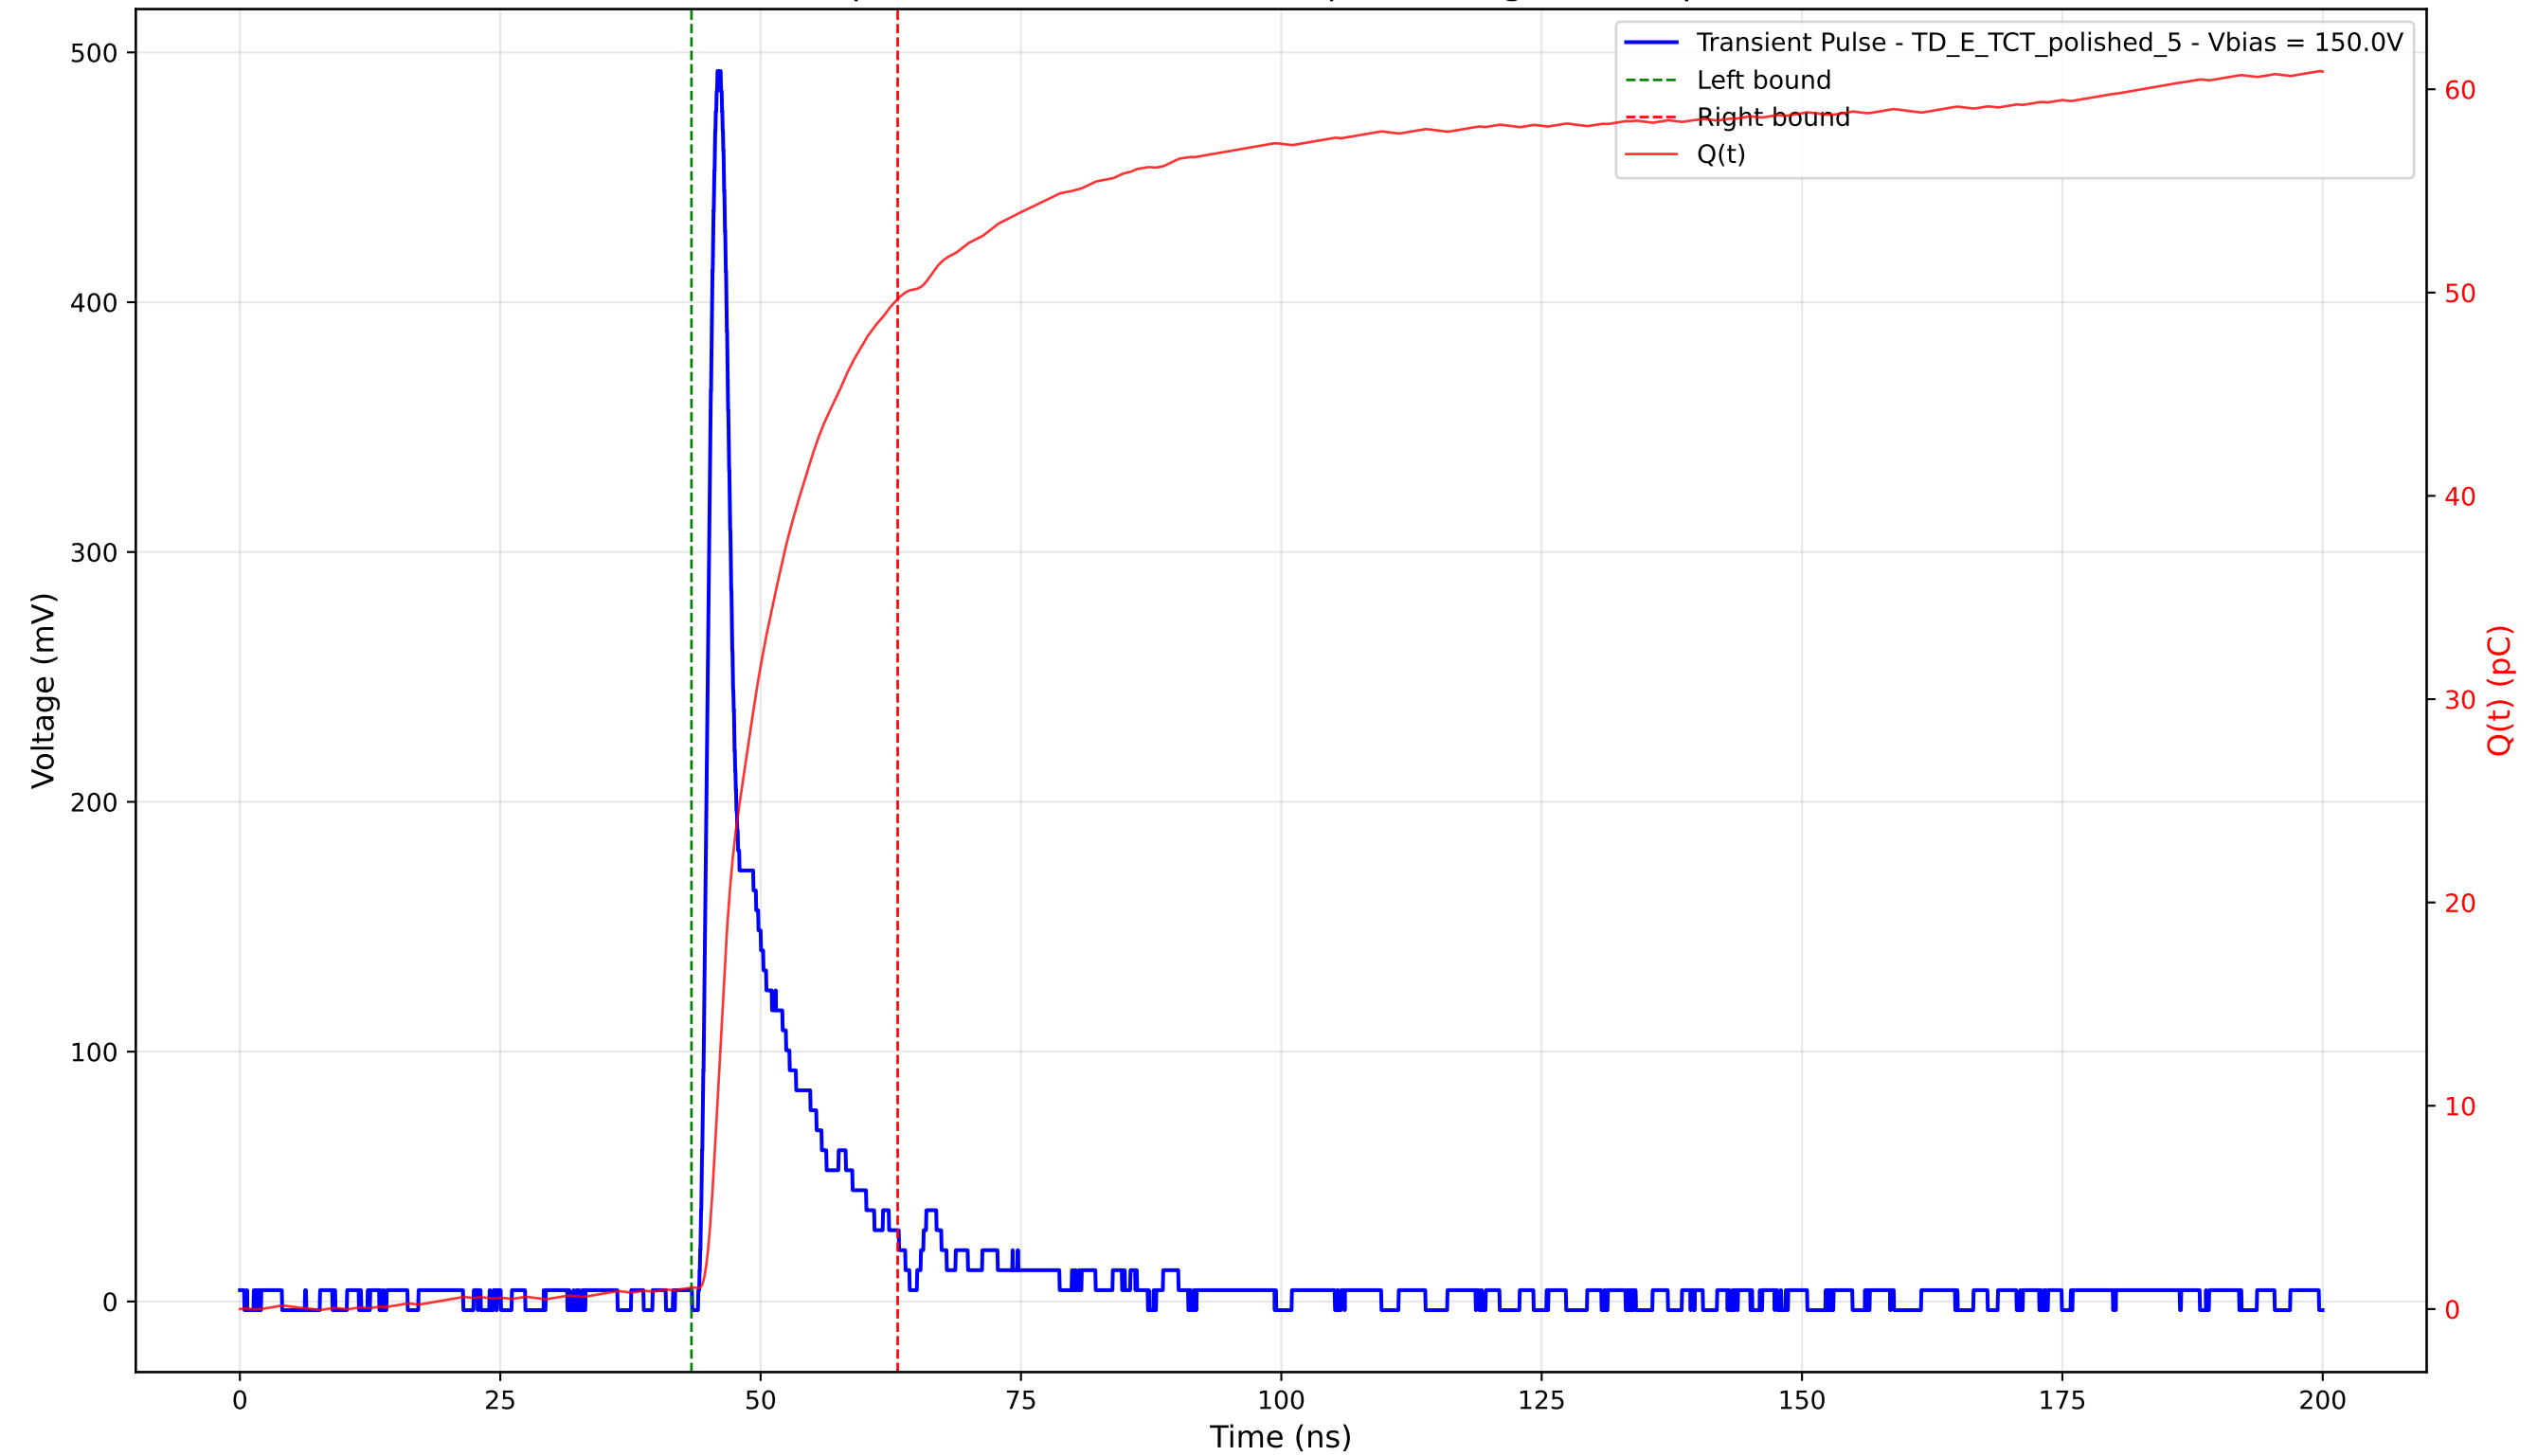


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 47.70 pC - Rise Time: 1.18 ns

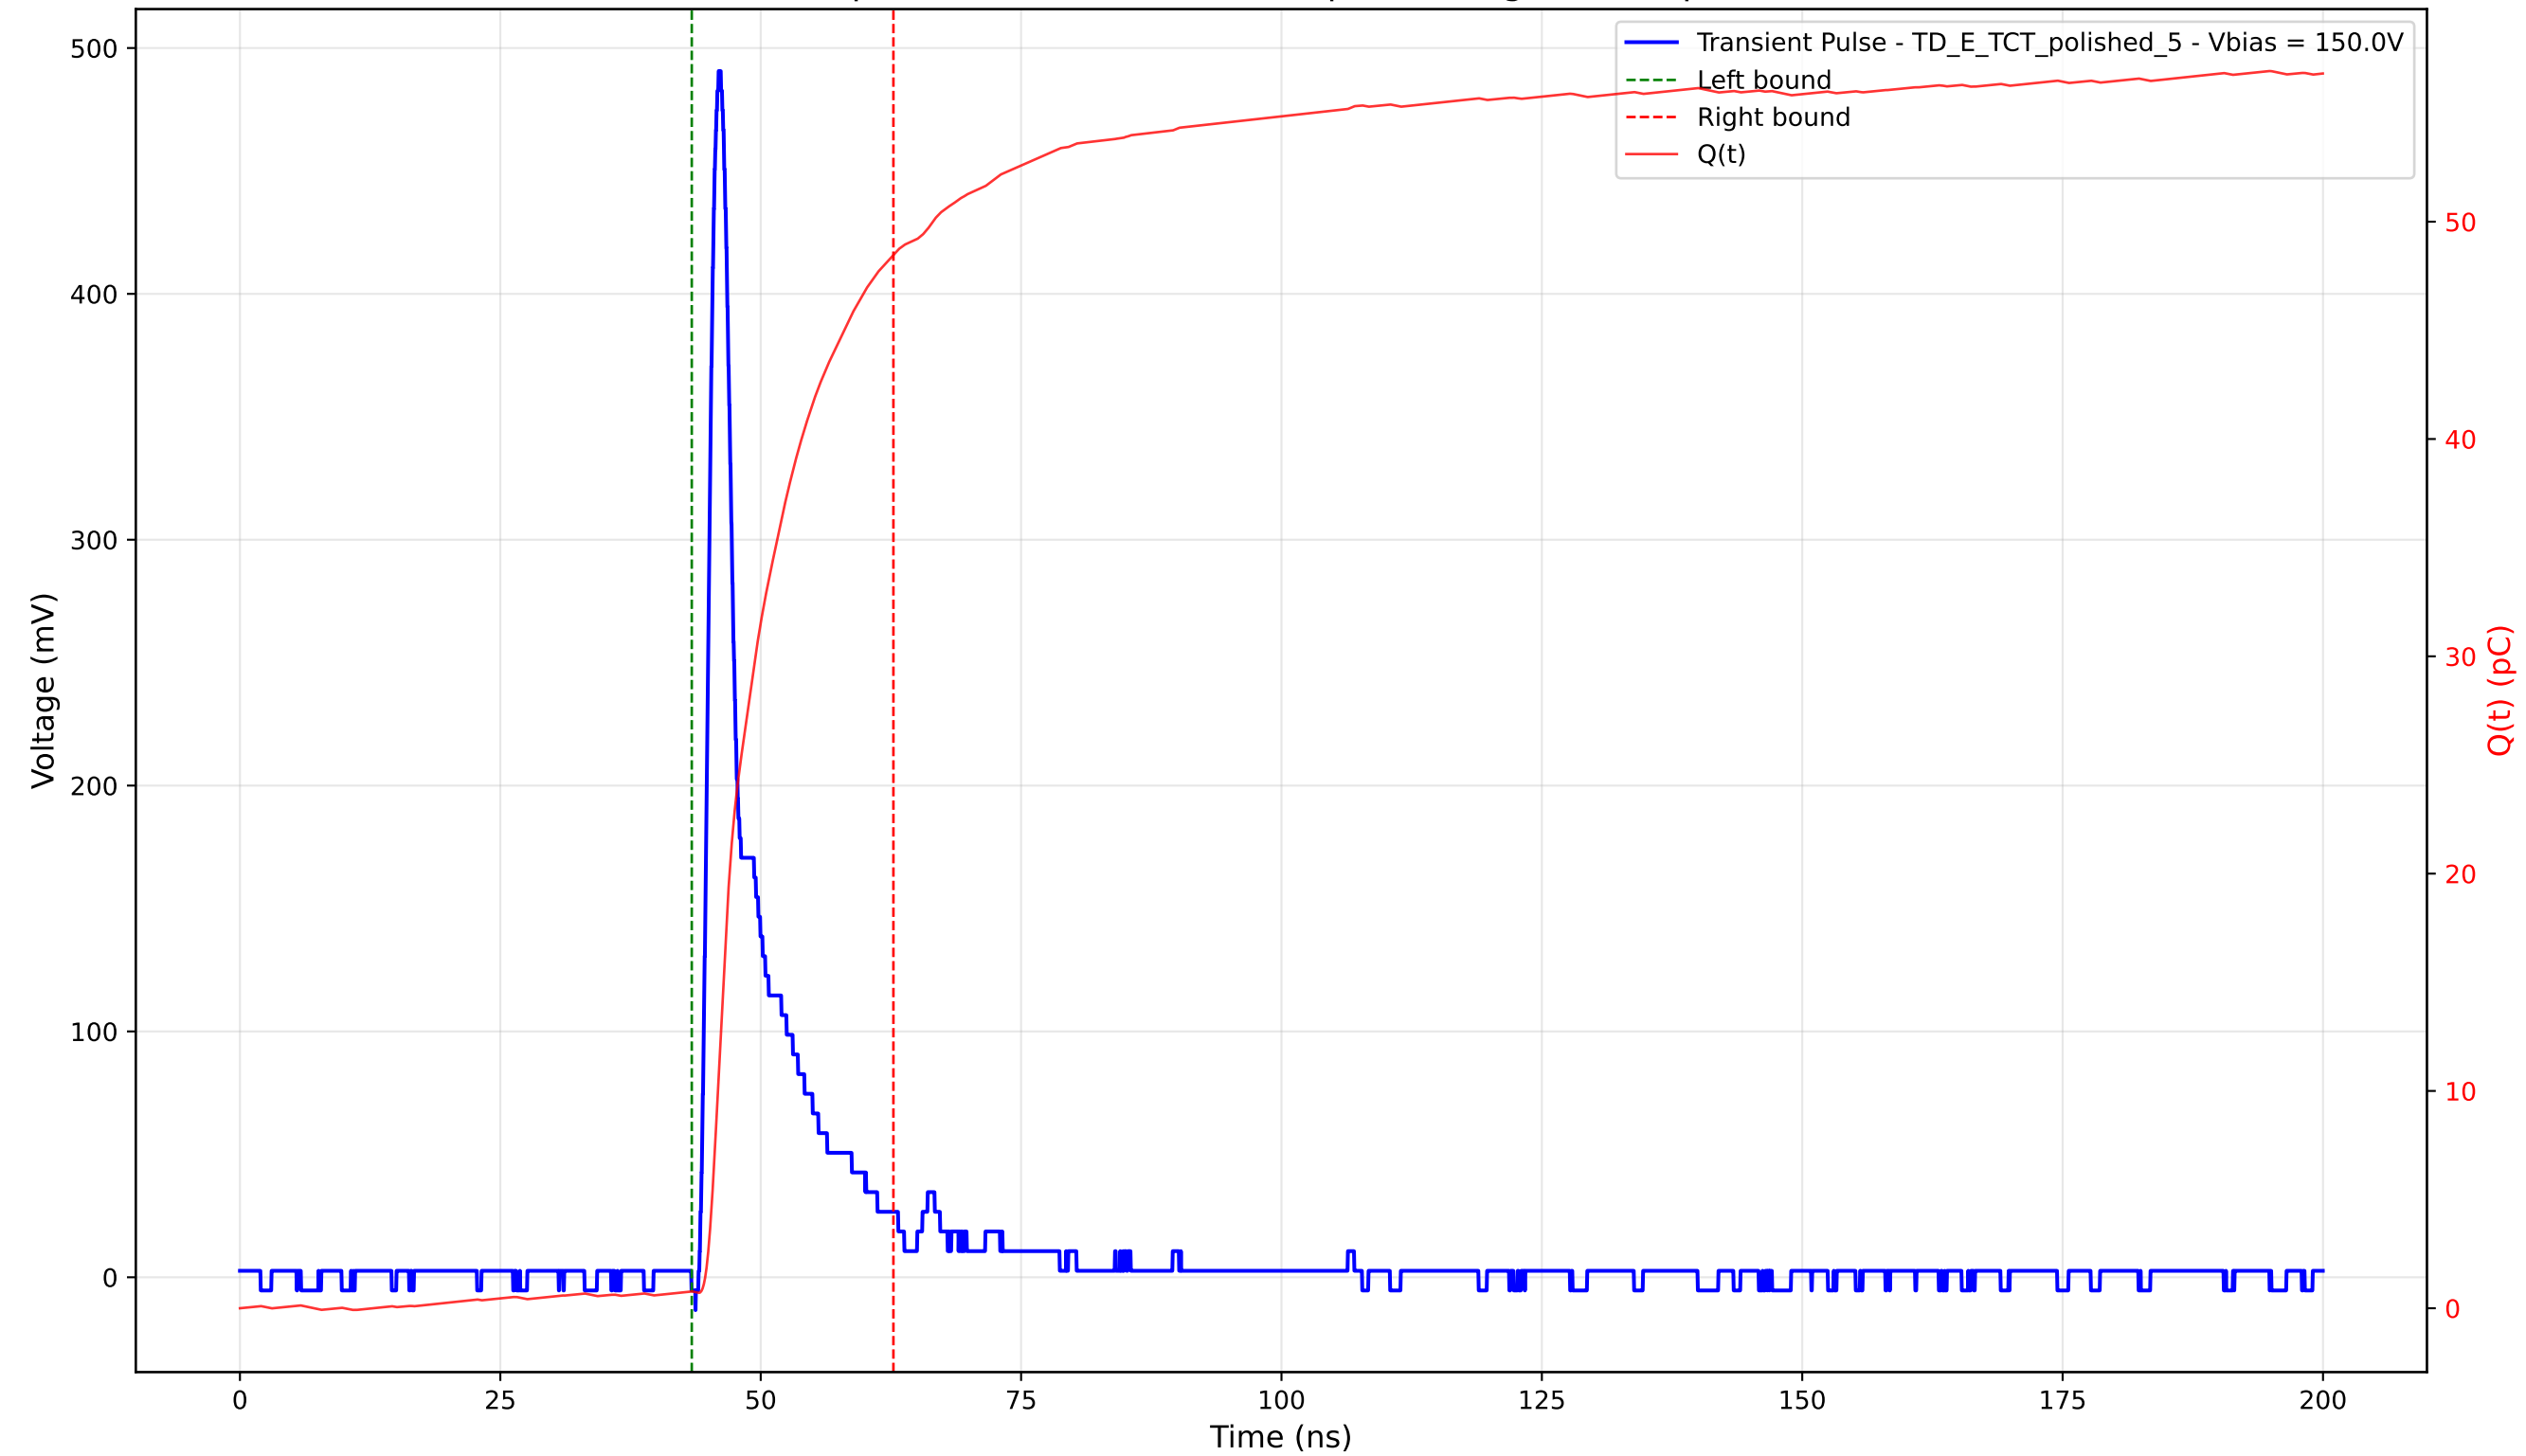


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 46.26 pC - Rise Time: 1.26 ns

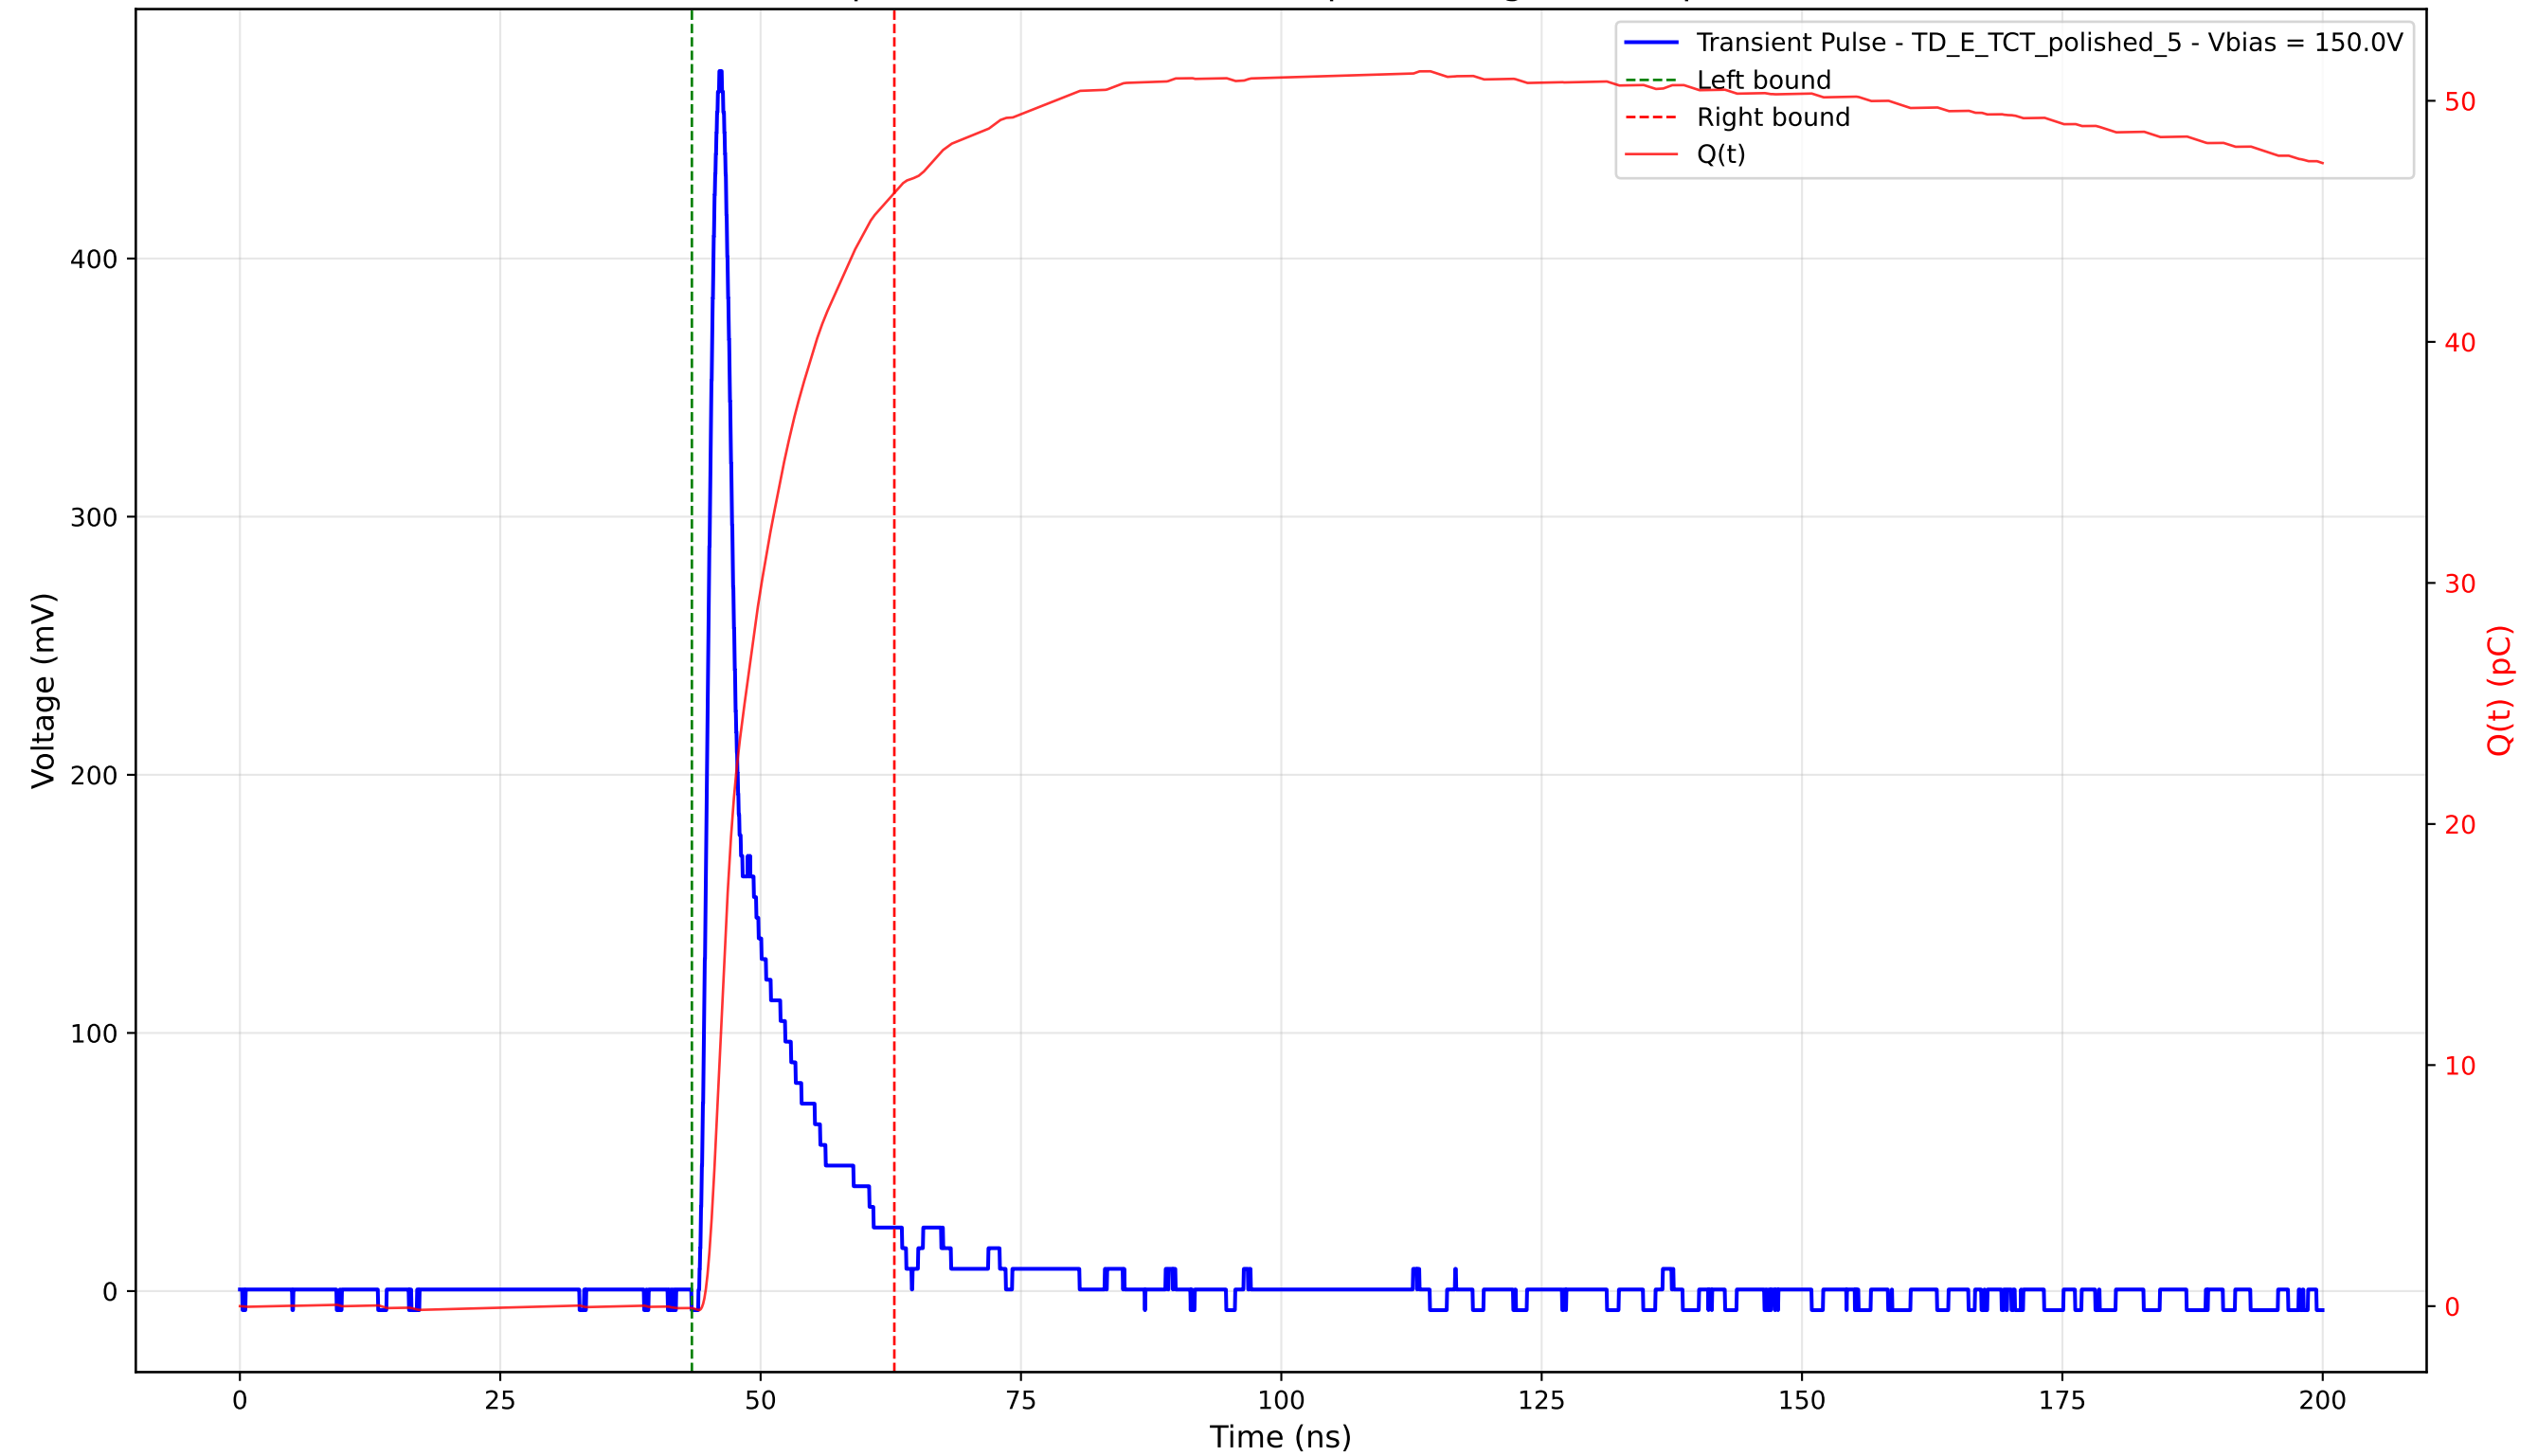


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 46.61 pC - Rise Time: 1.25 ns

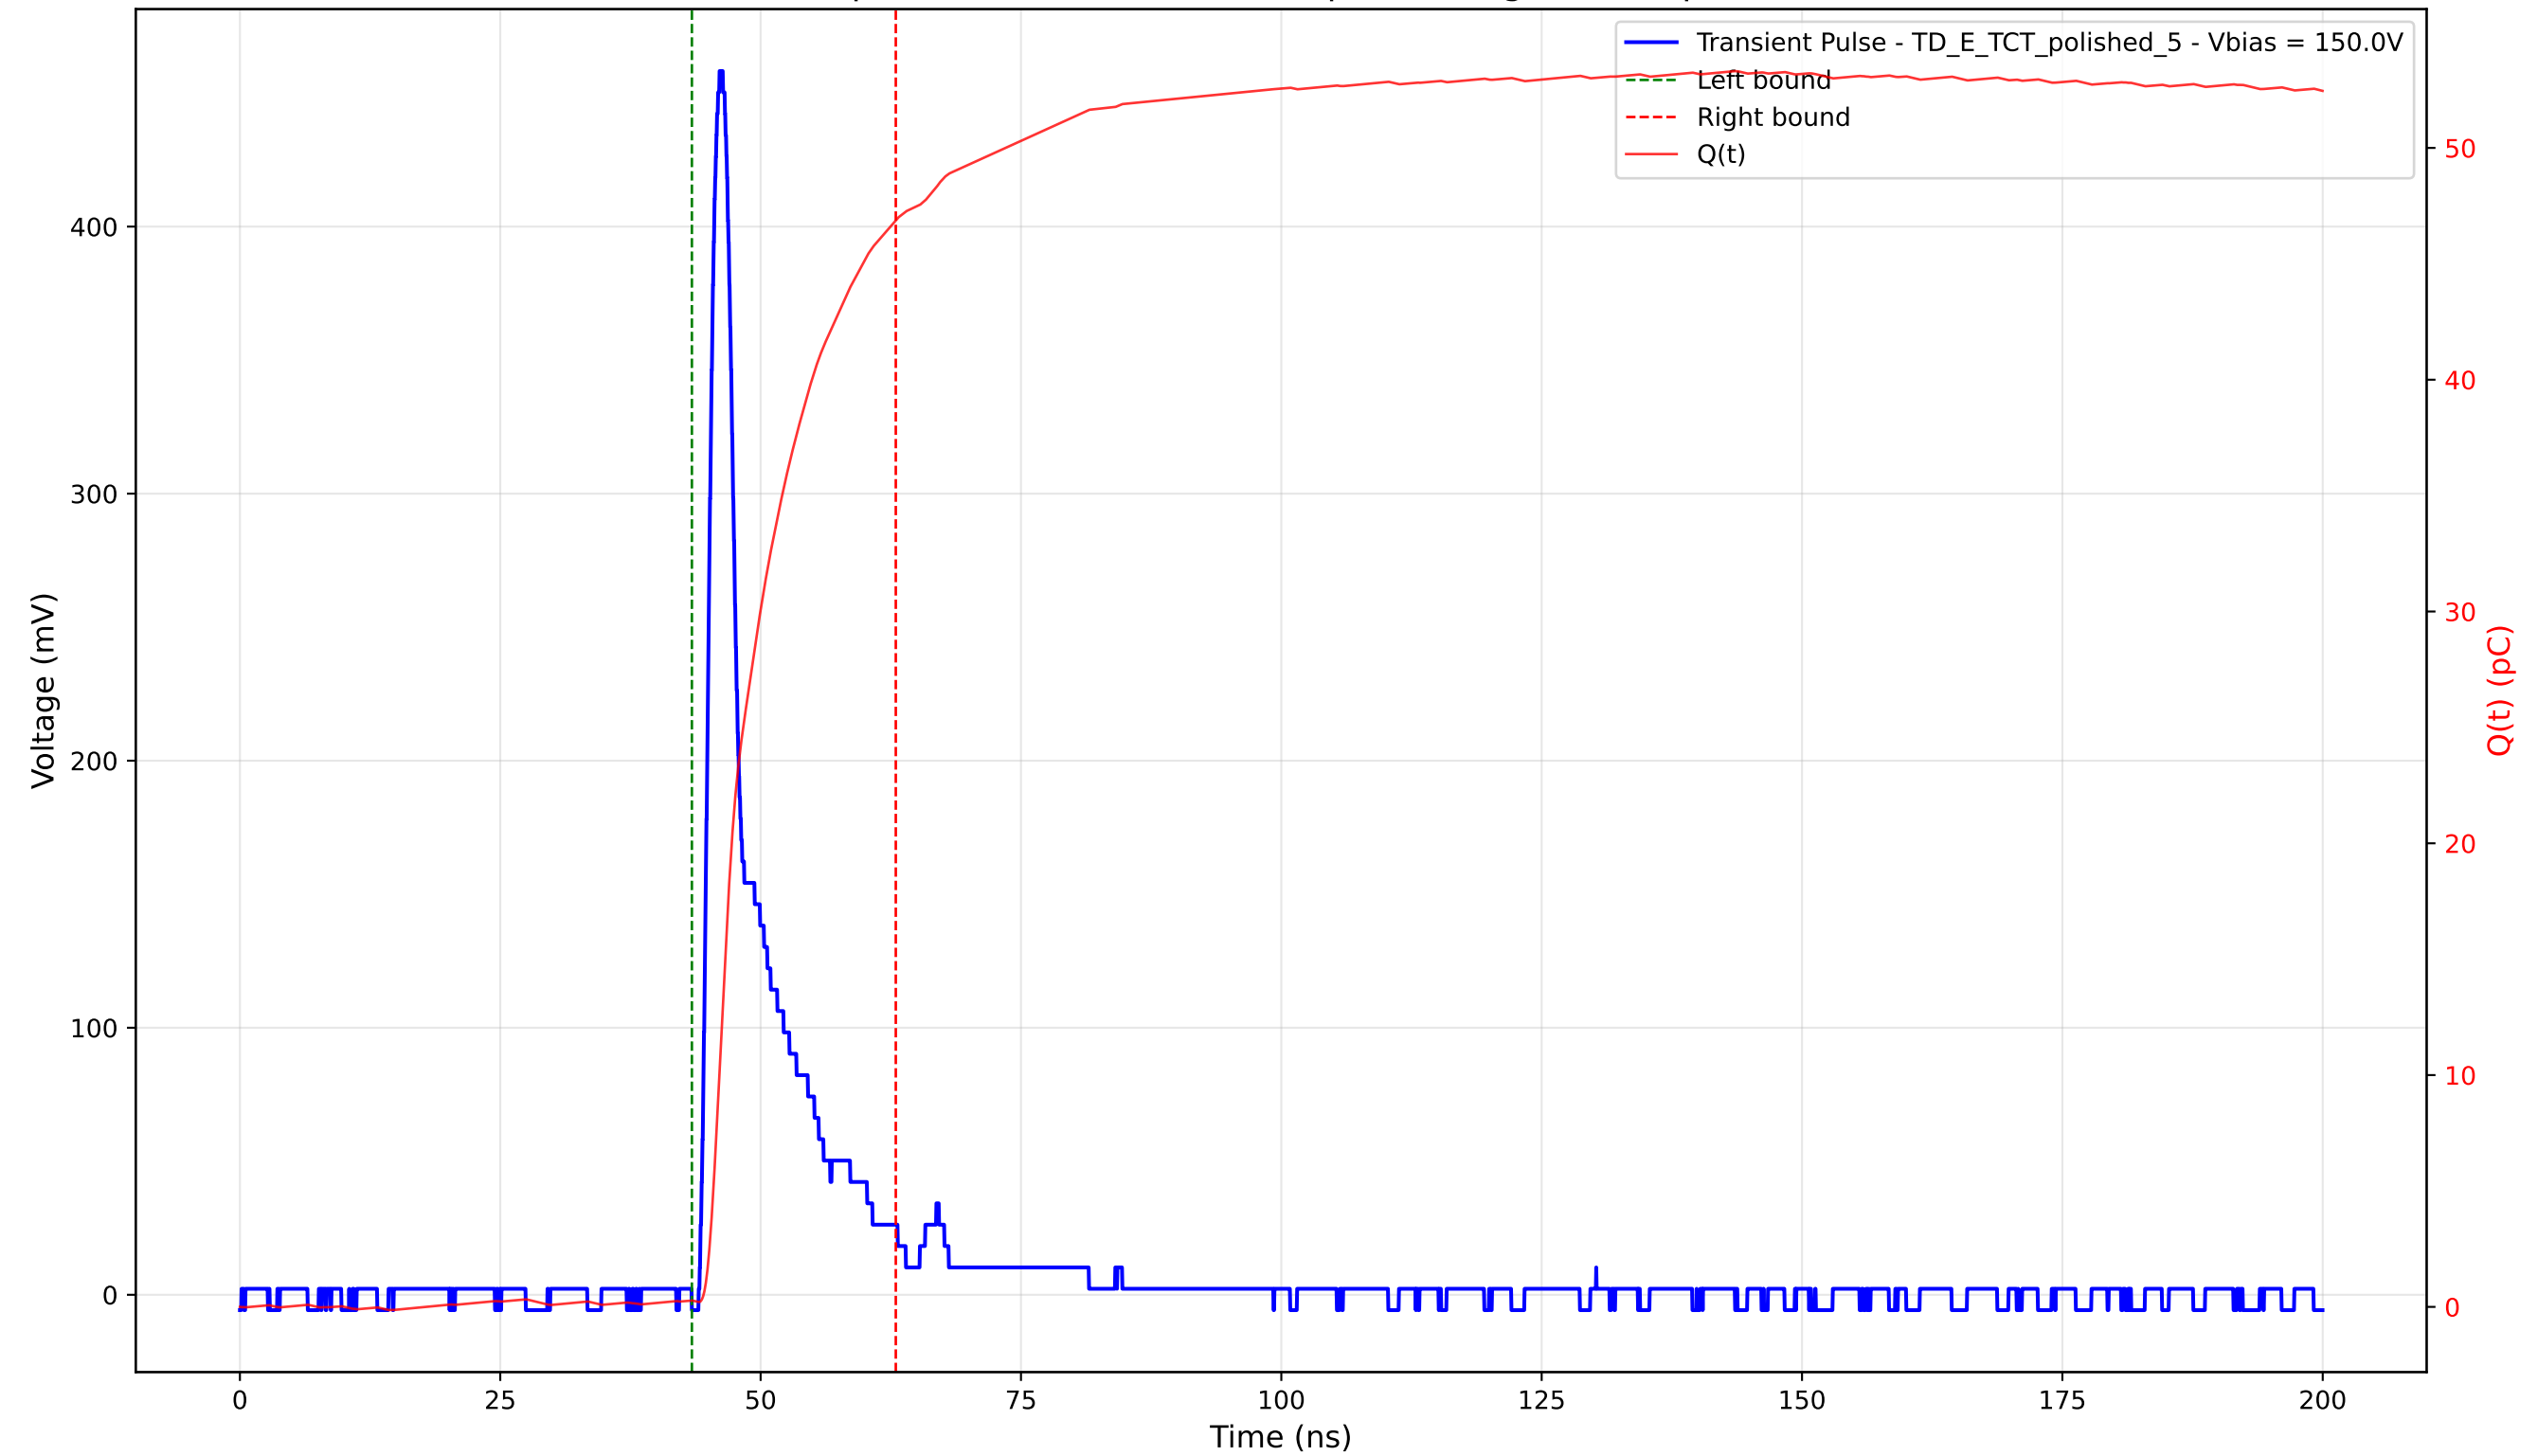


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 45.40 pC - Rise Time: 1.25 ns

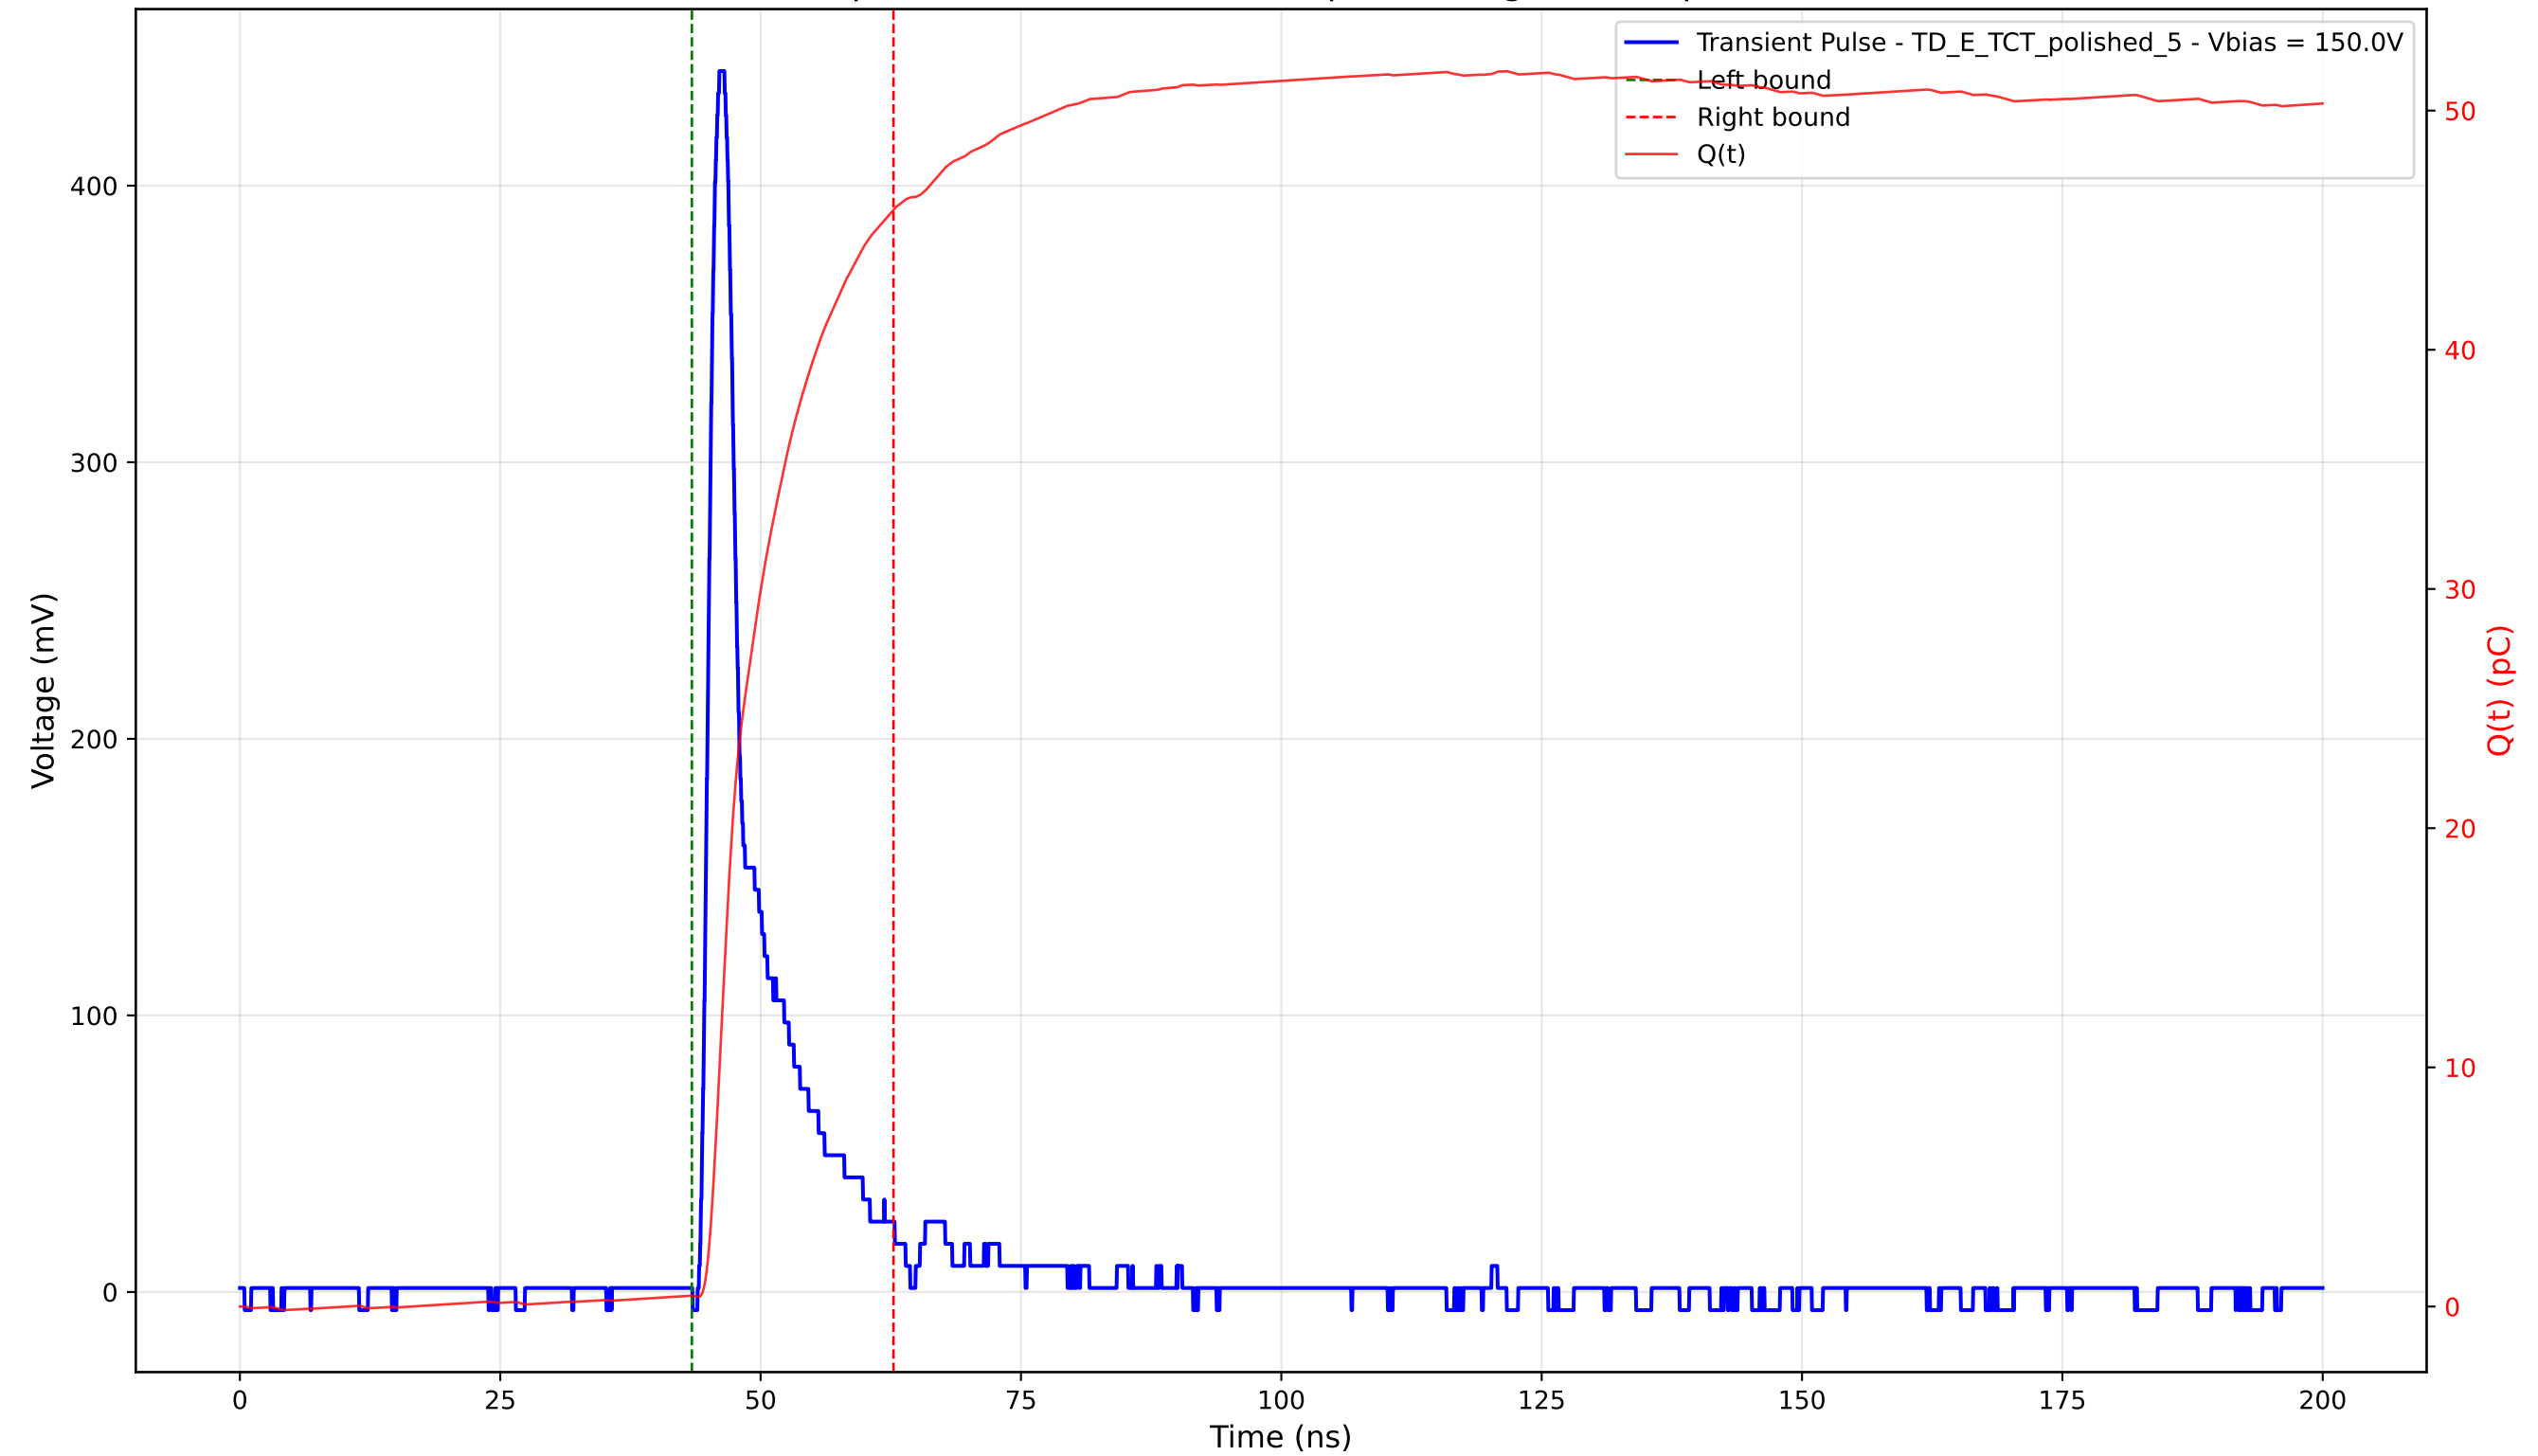


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 45.53 pC - Rise Time: 1.28 ns

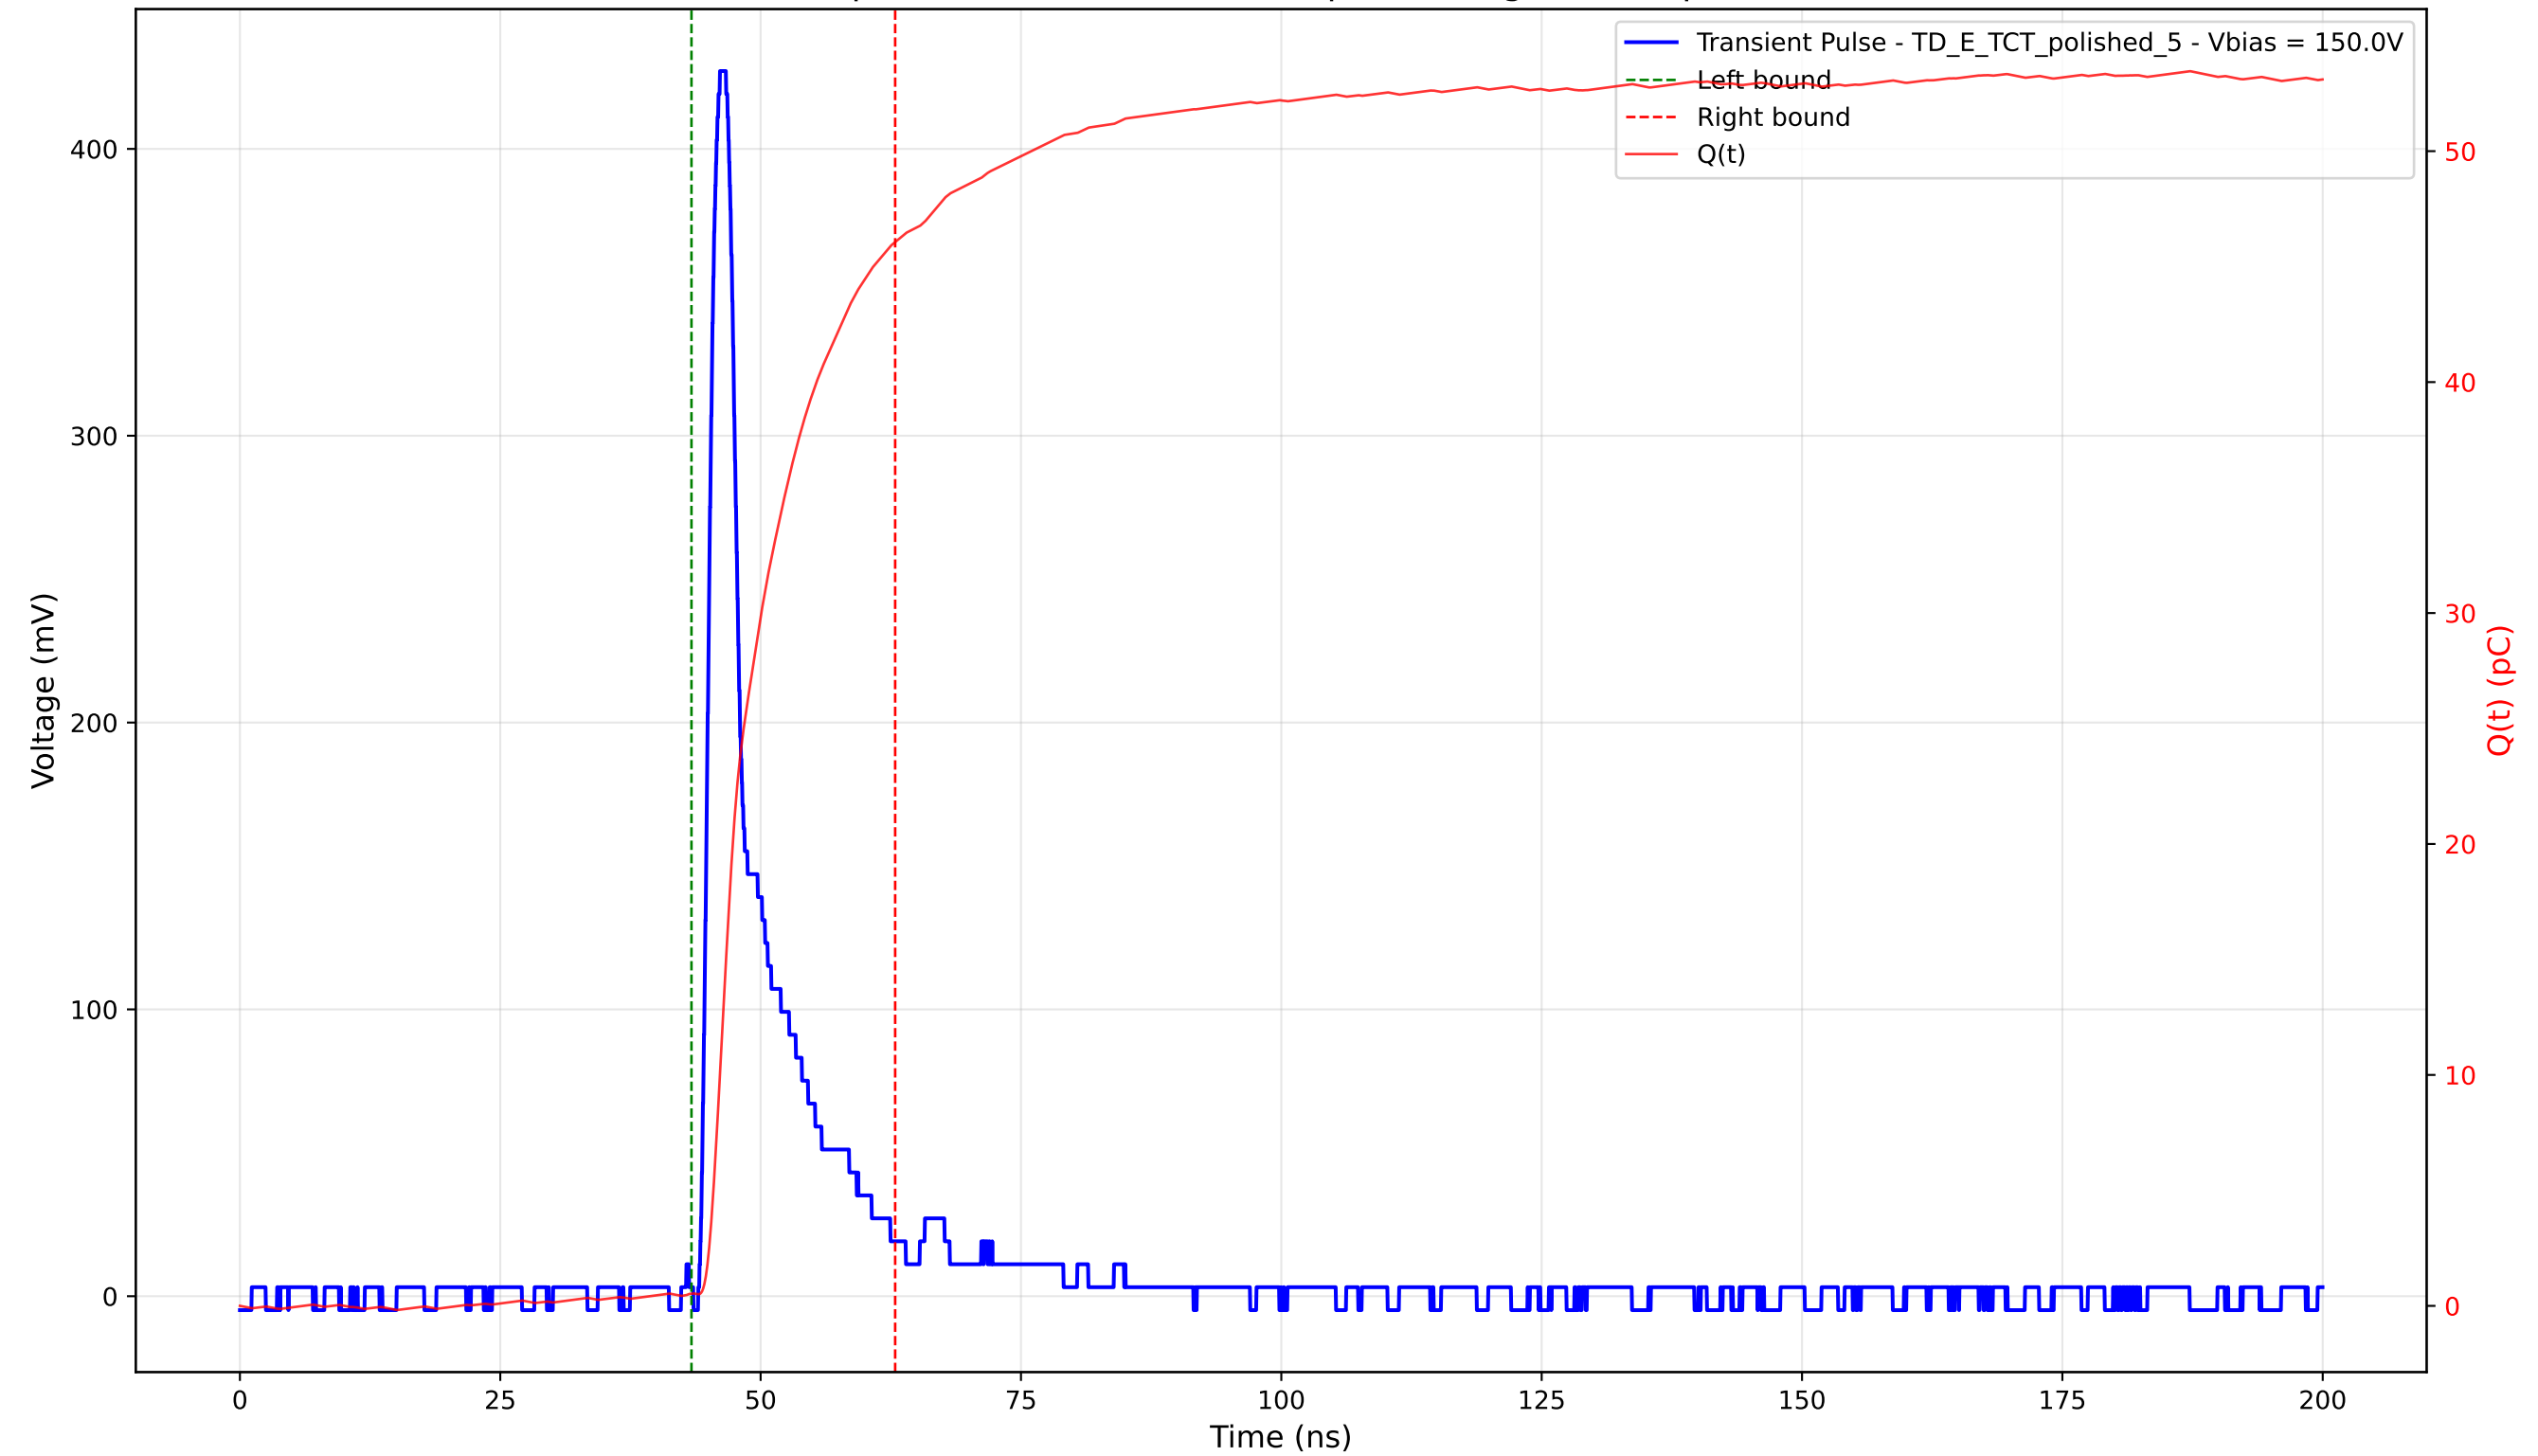


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 44.96 pC - Rise Time: 1.30 ns

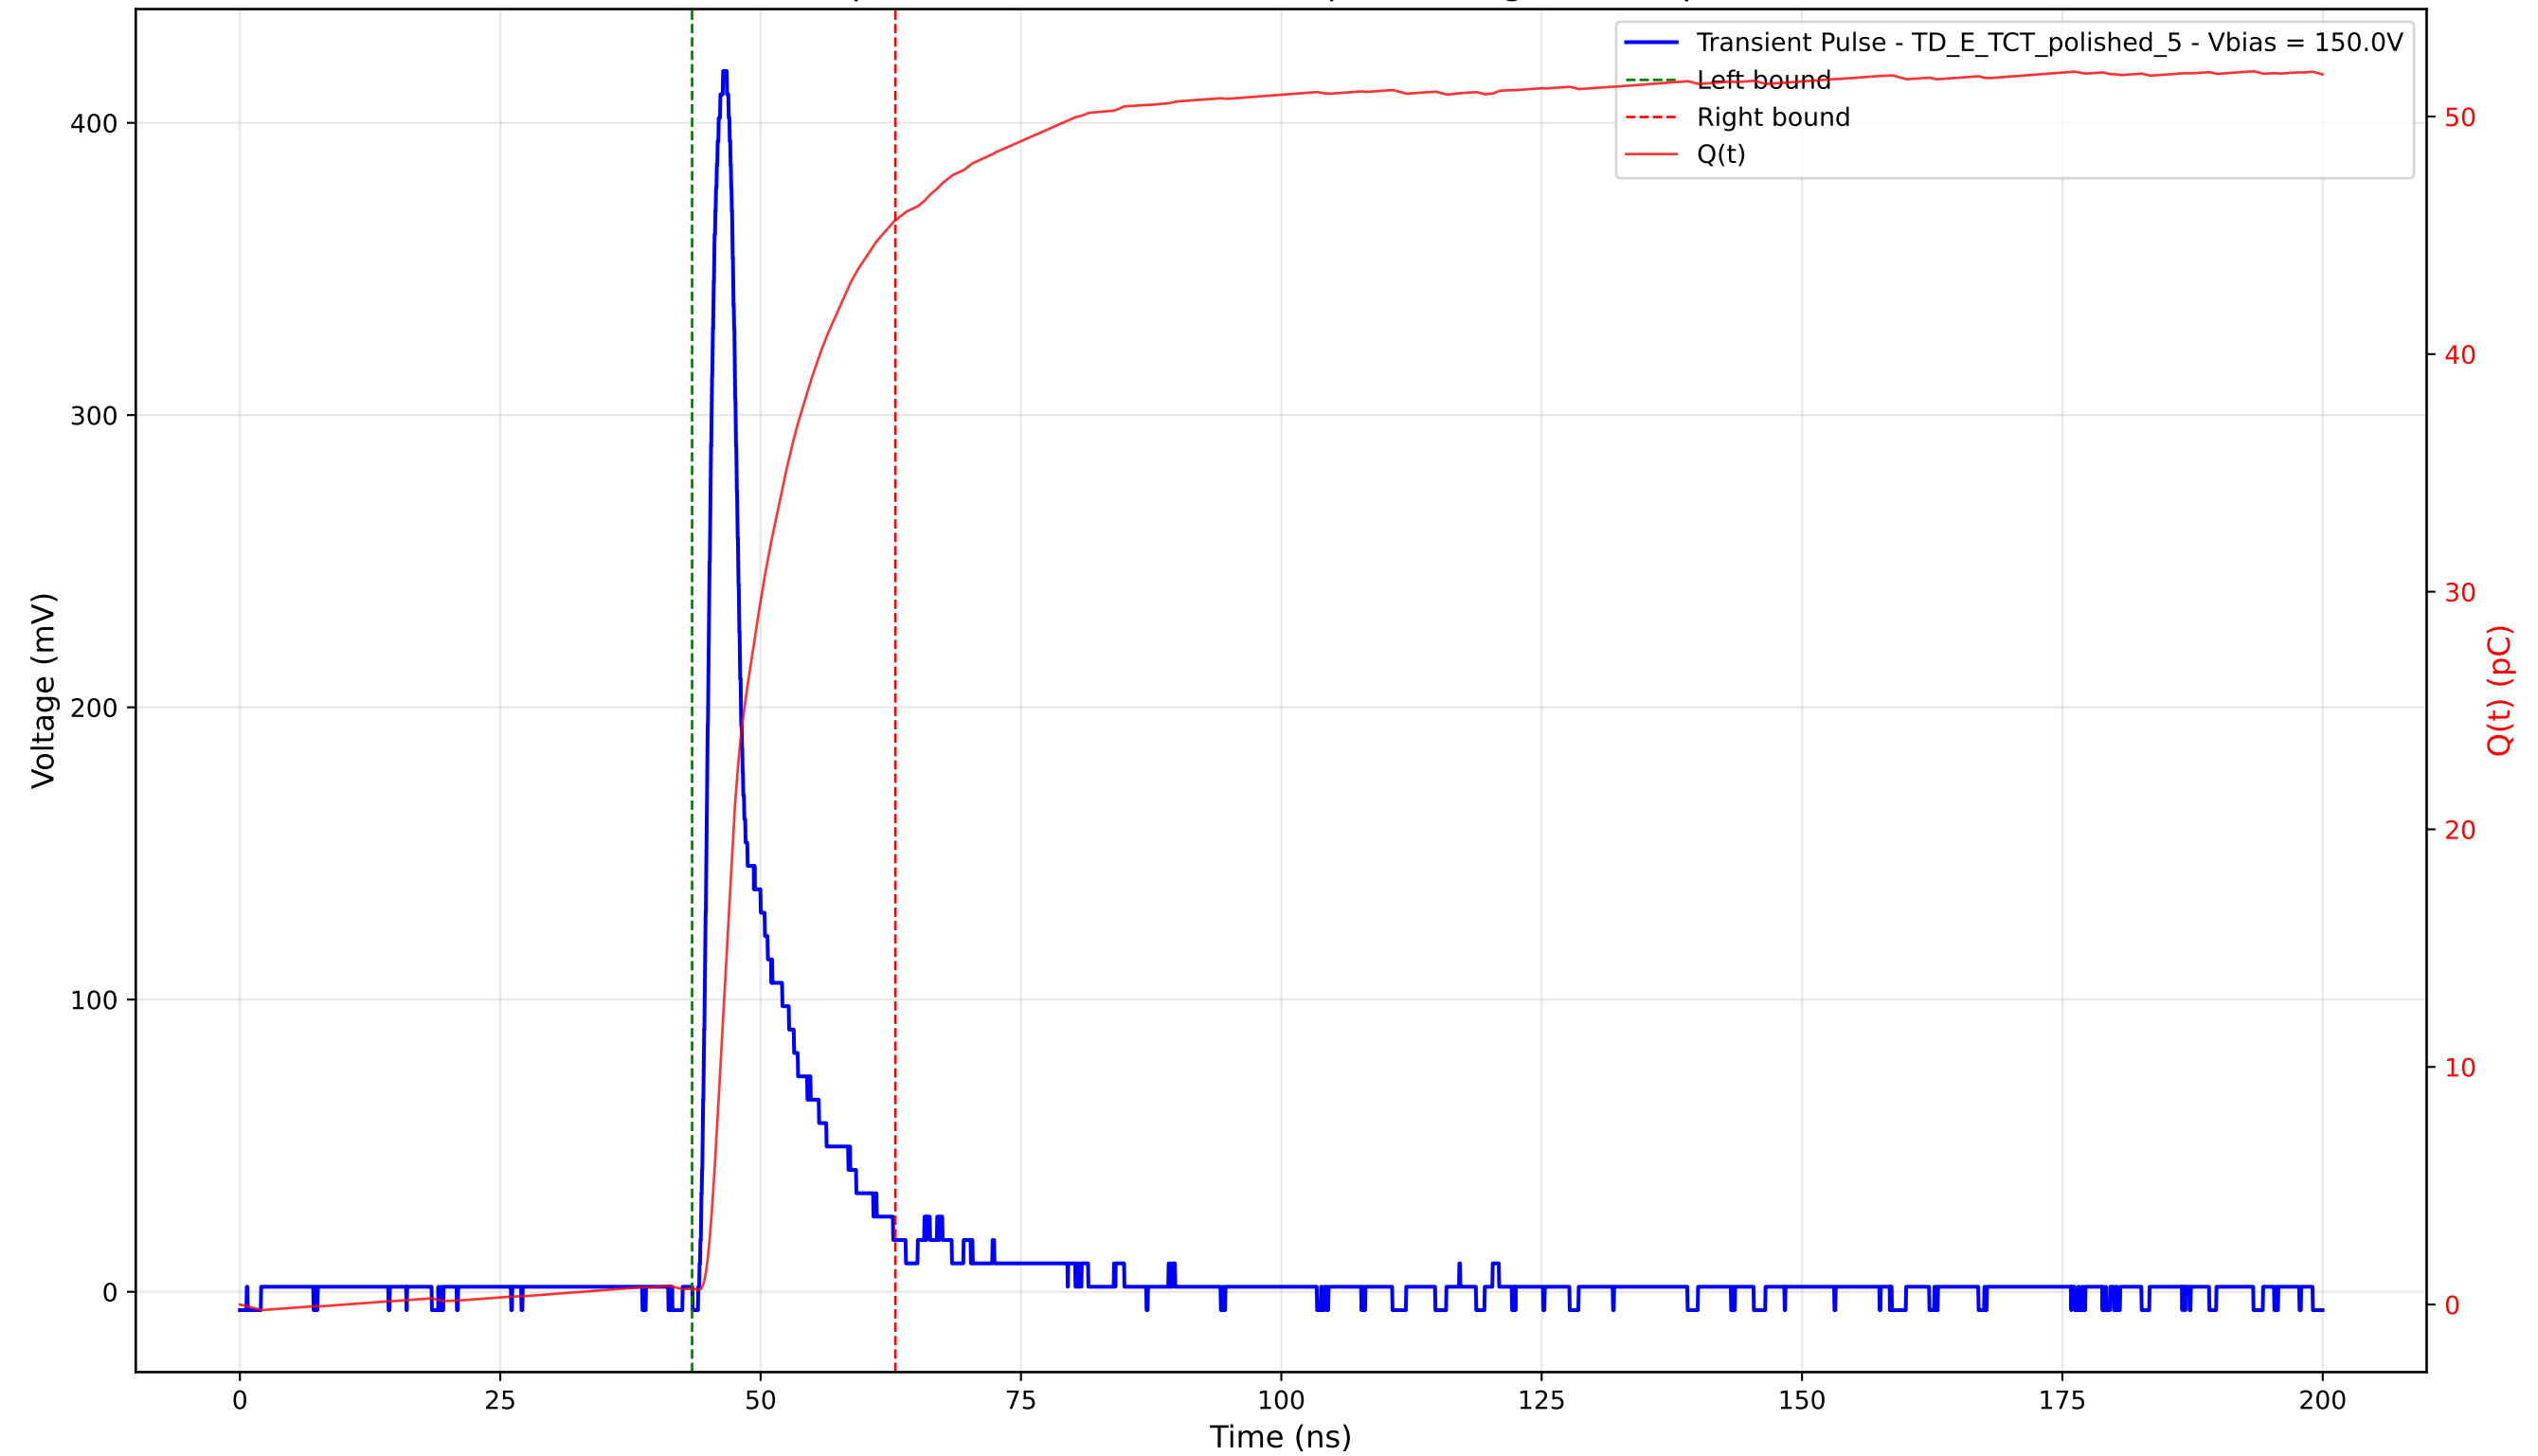


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 43.57 pC - Rise Time: 1.38 ns

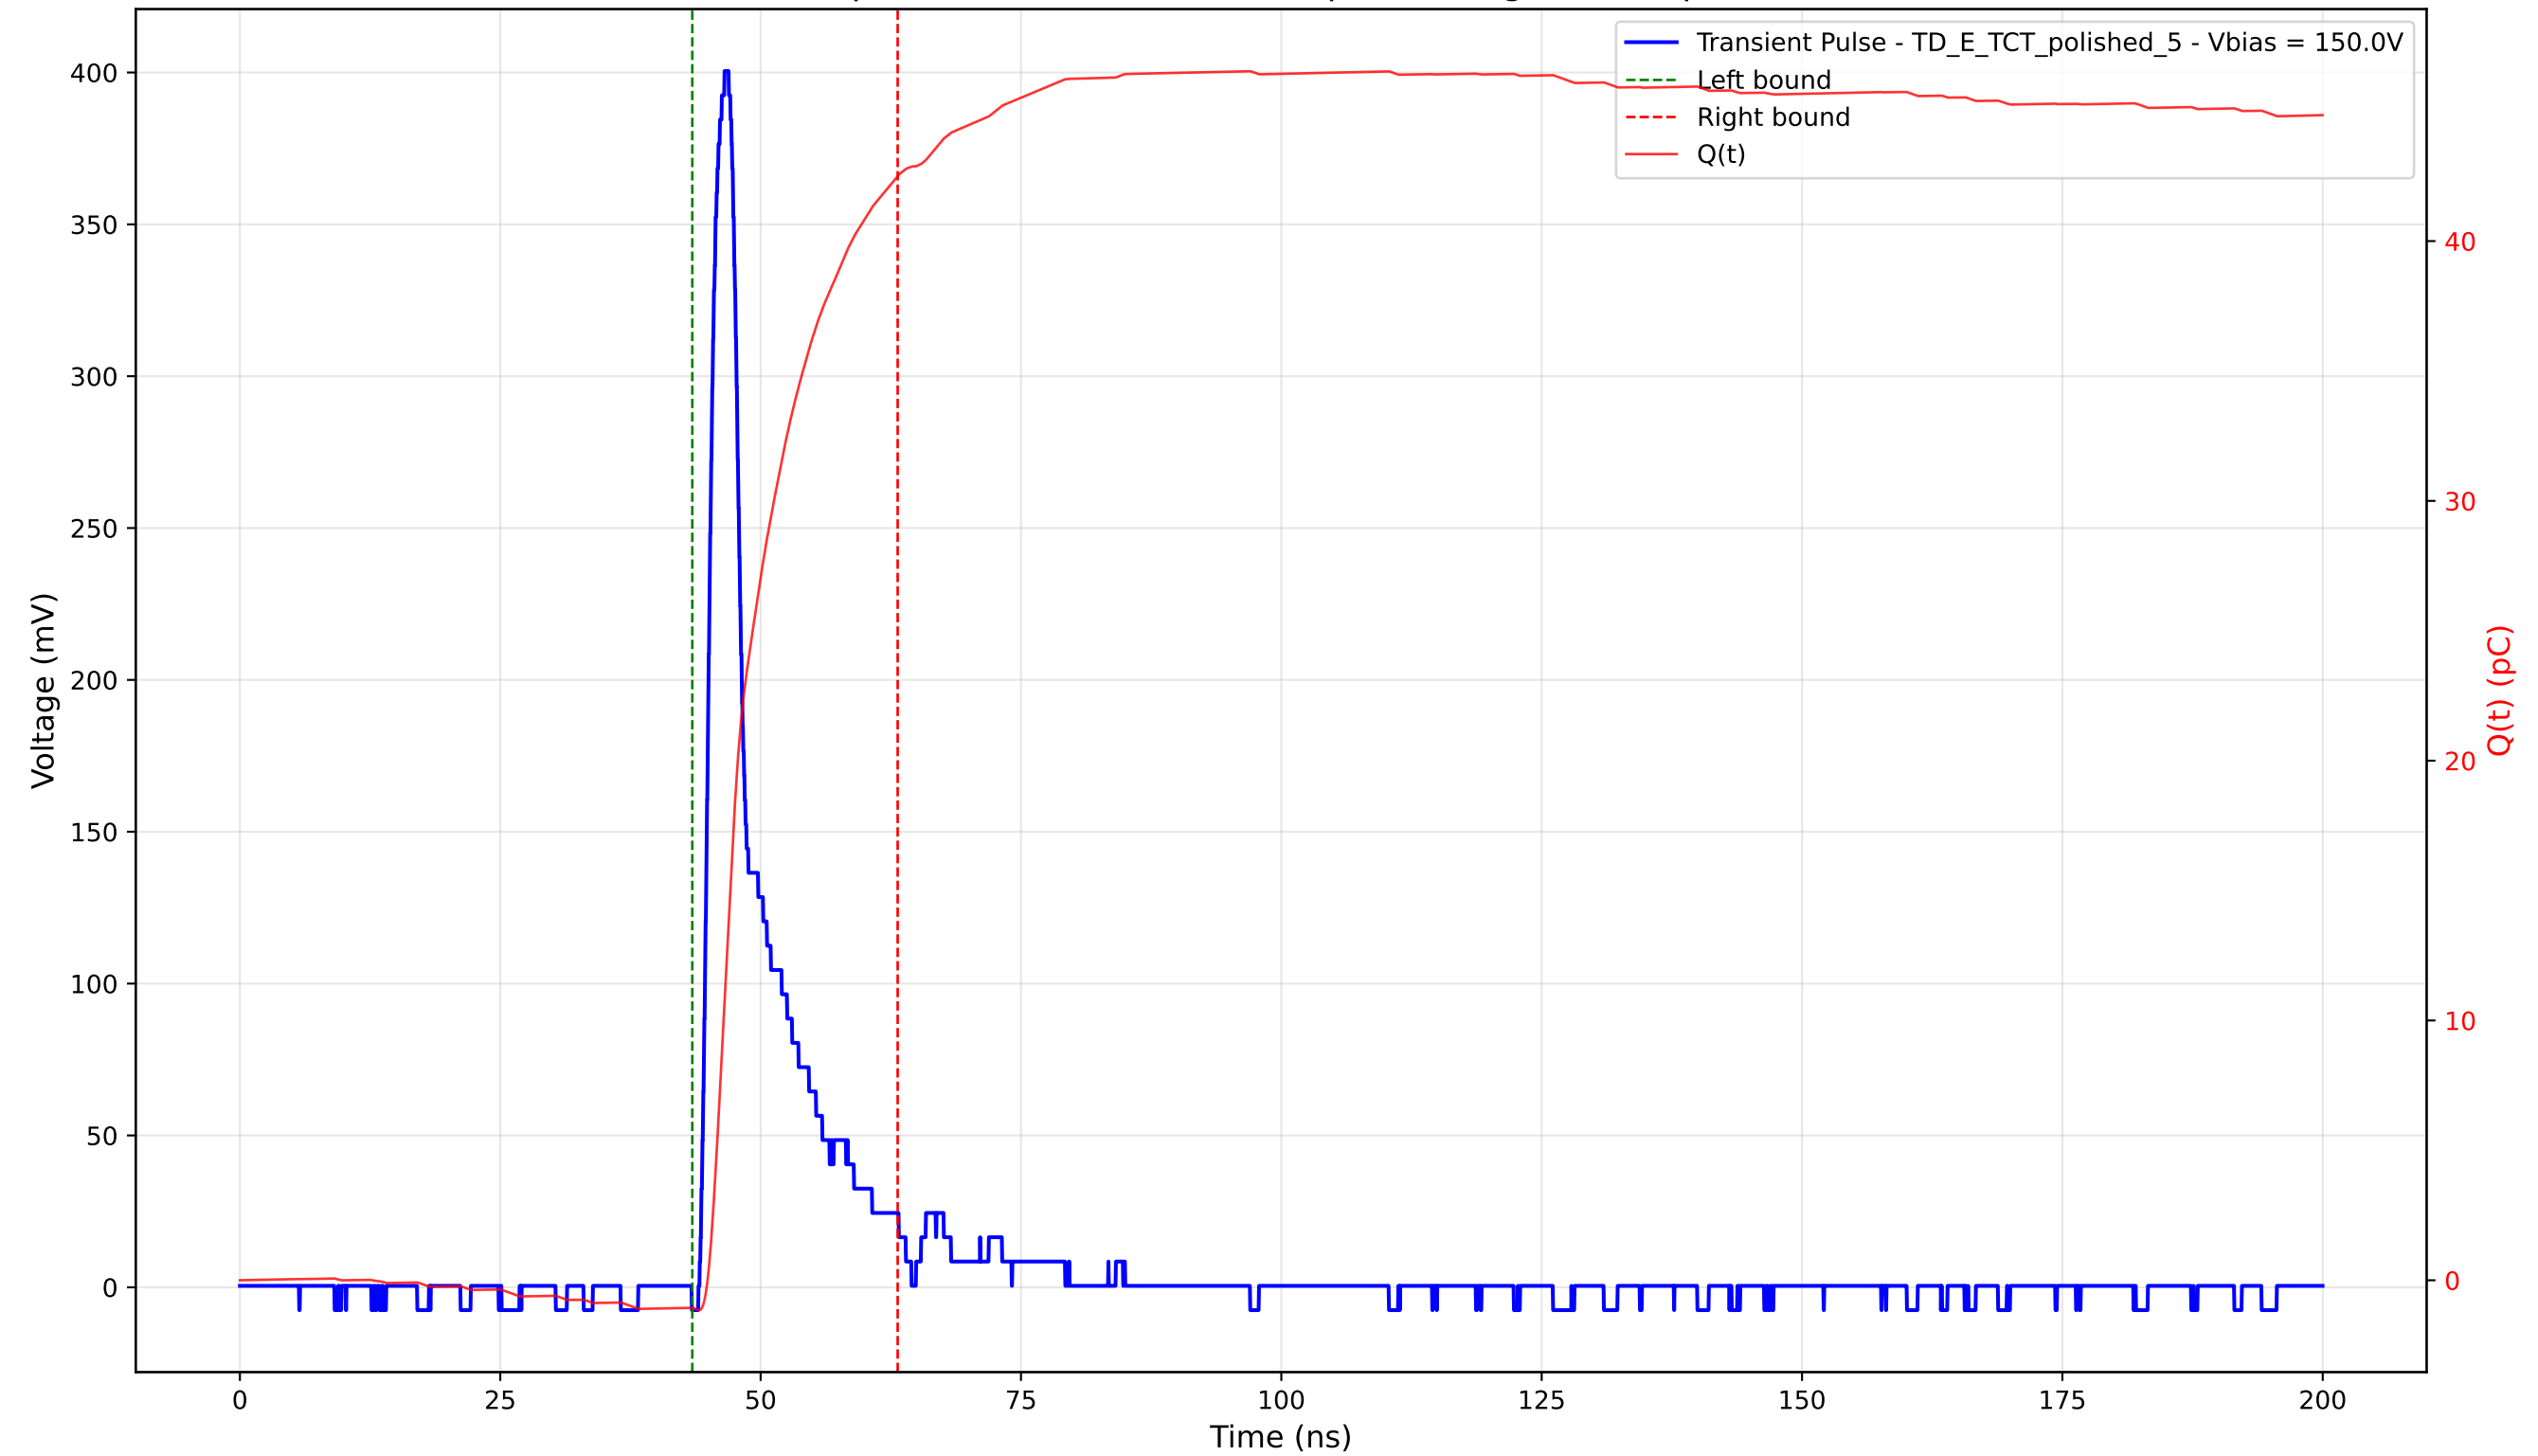


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 44.00 pC - Rise Time: 1.44 ns

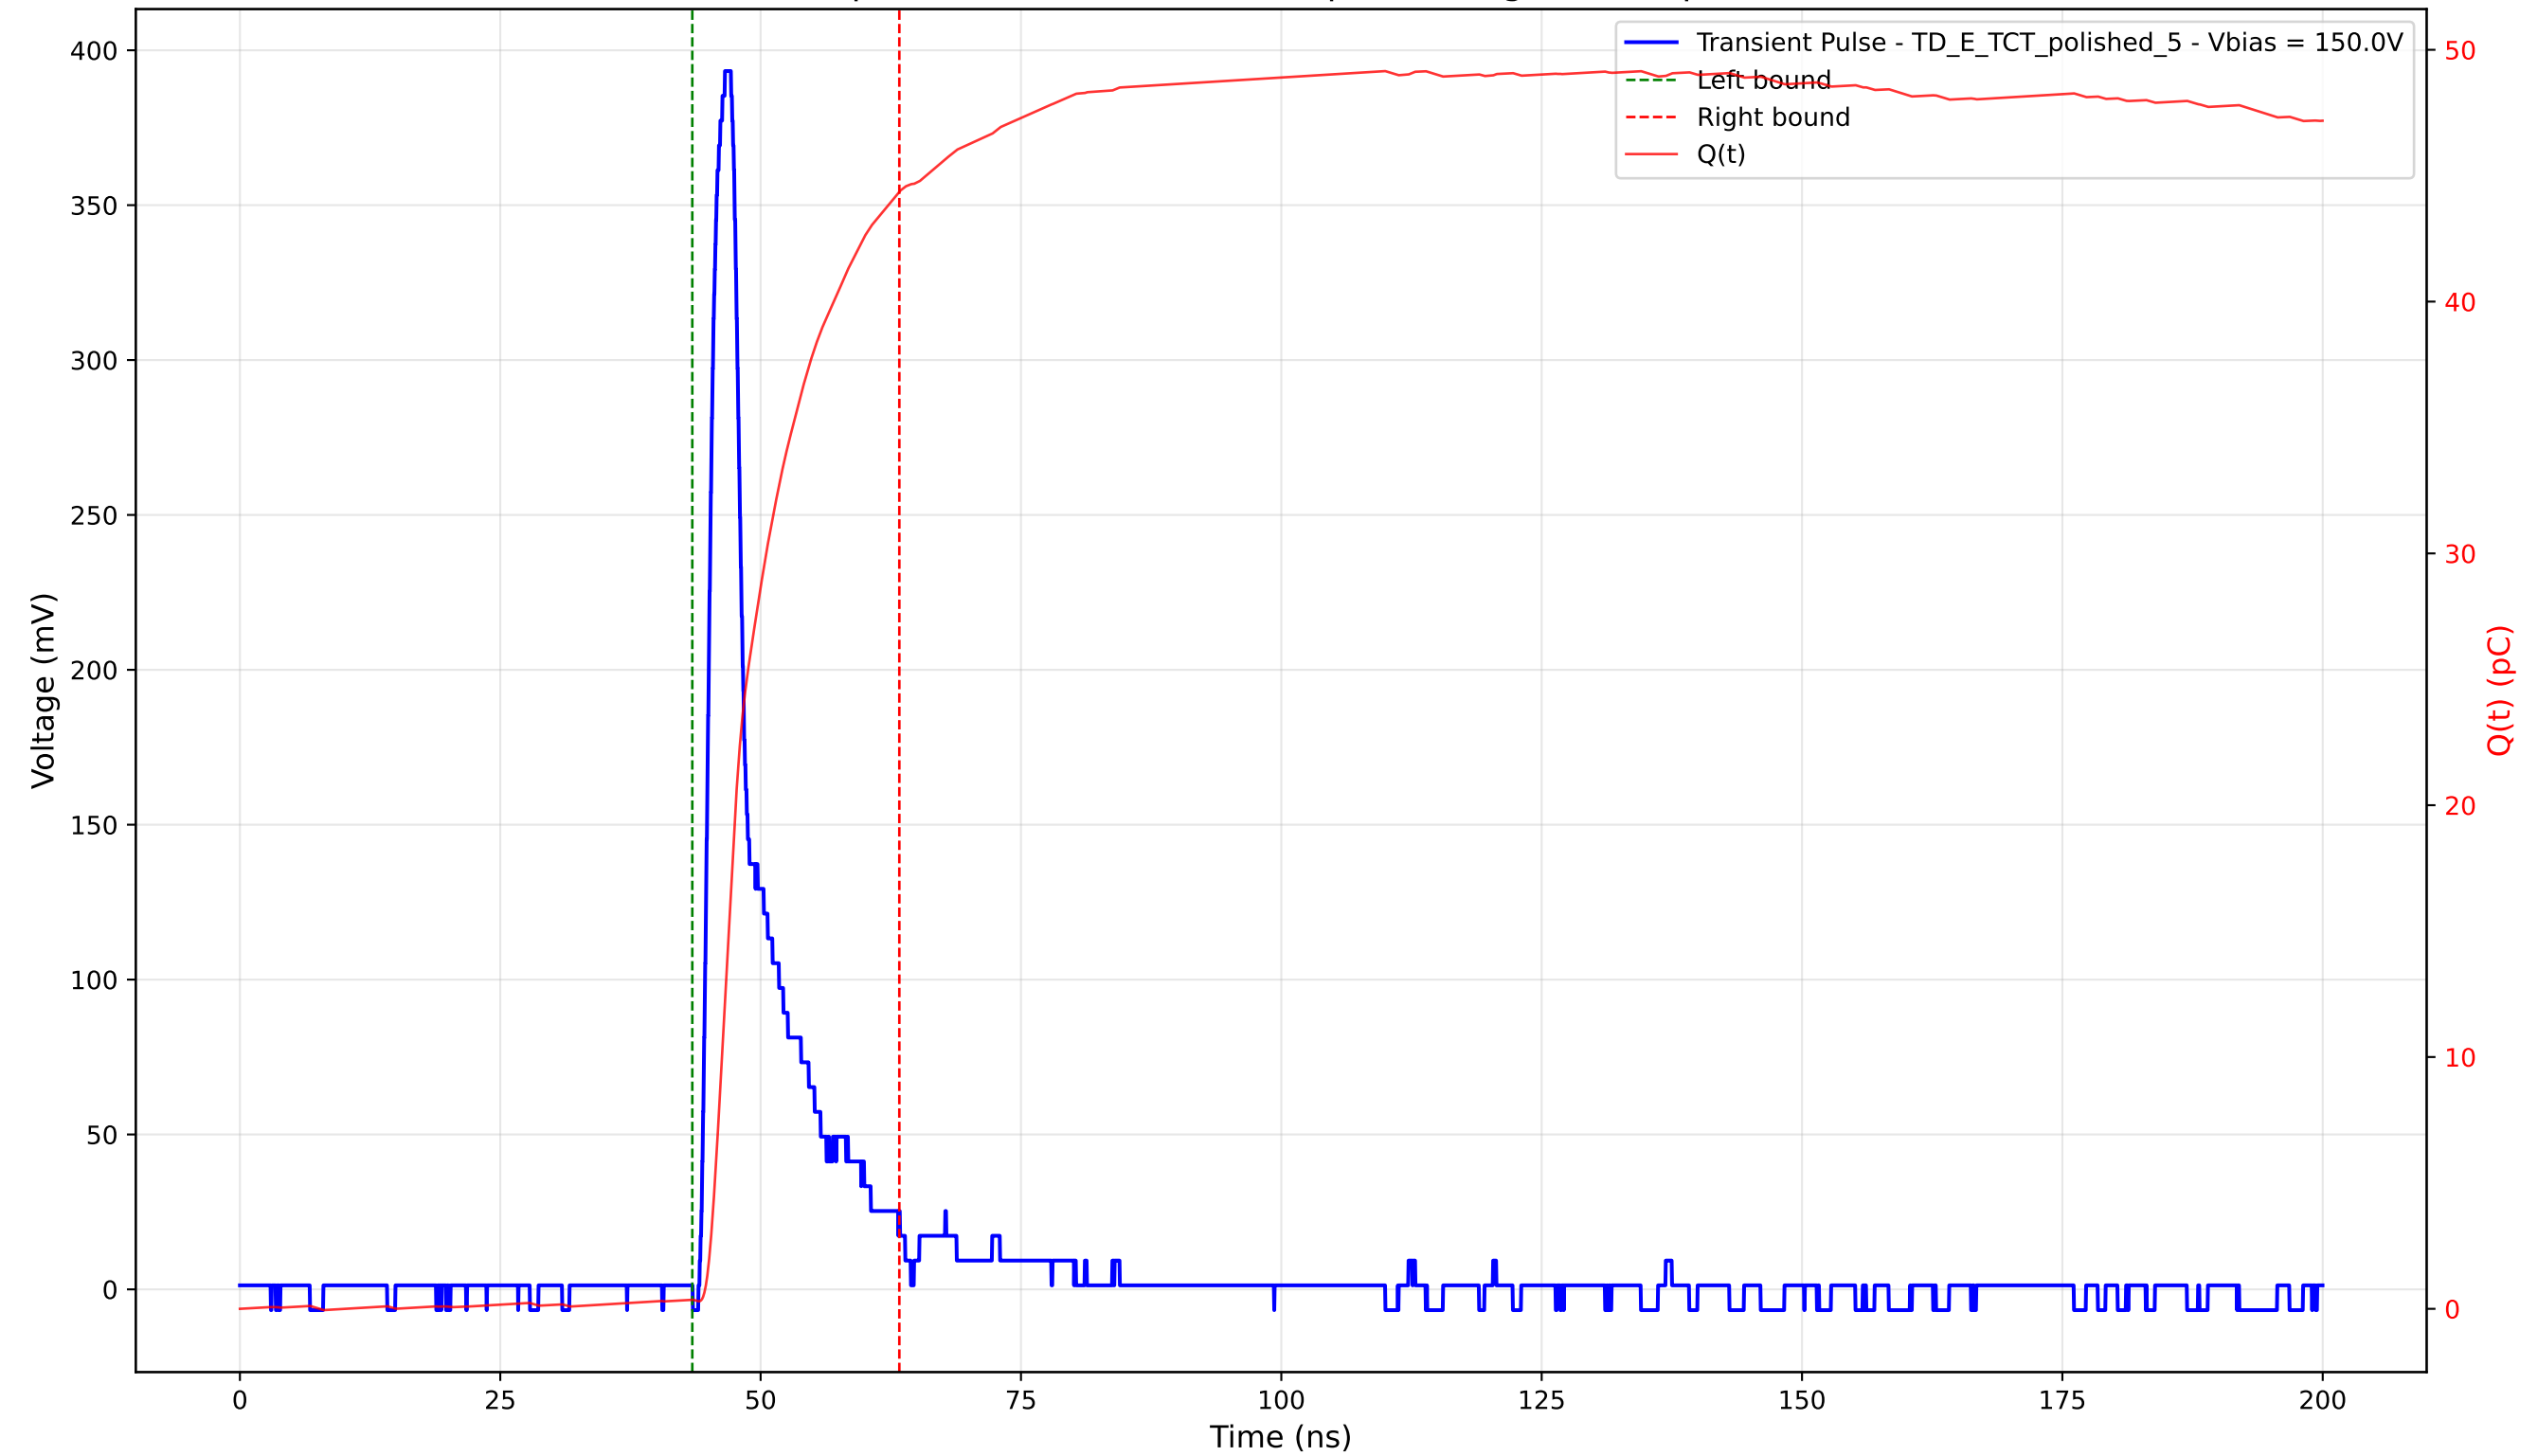


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 43.08 pC - Rise Time: 1.53 ns

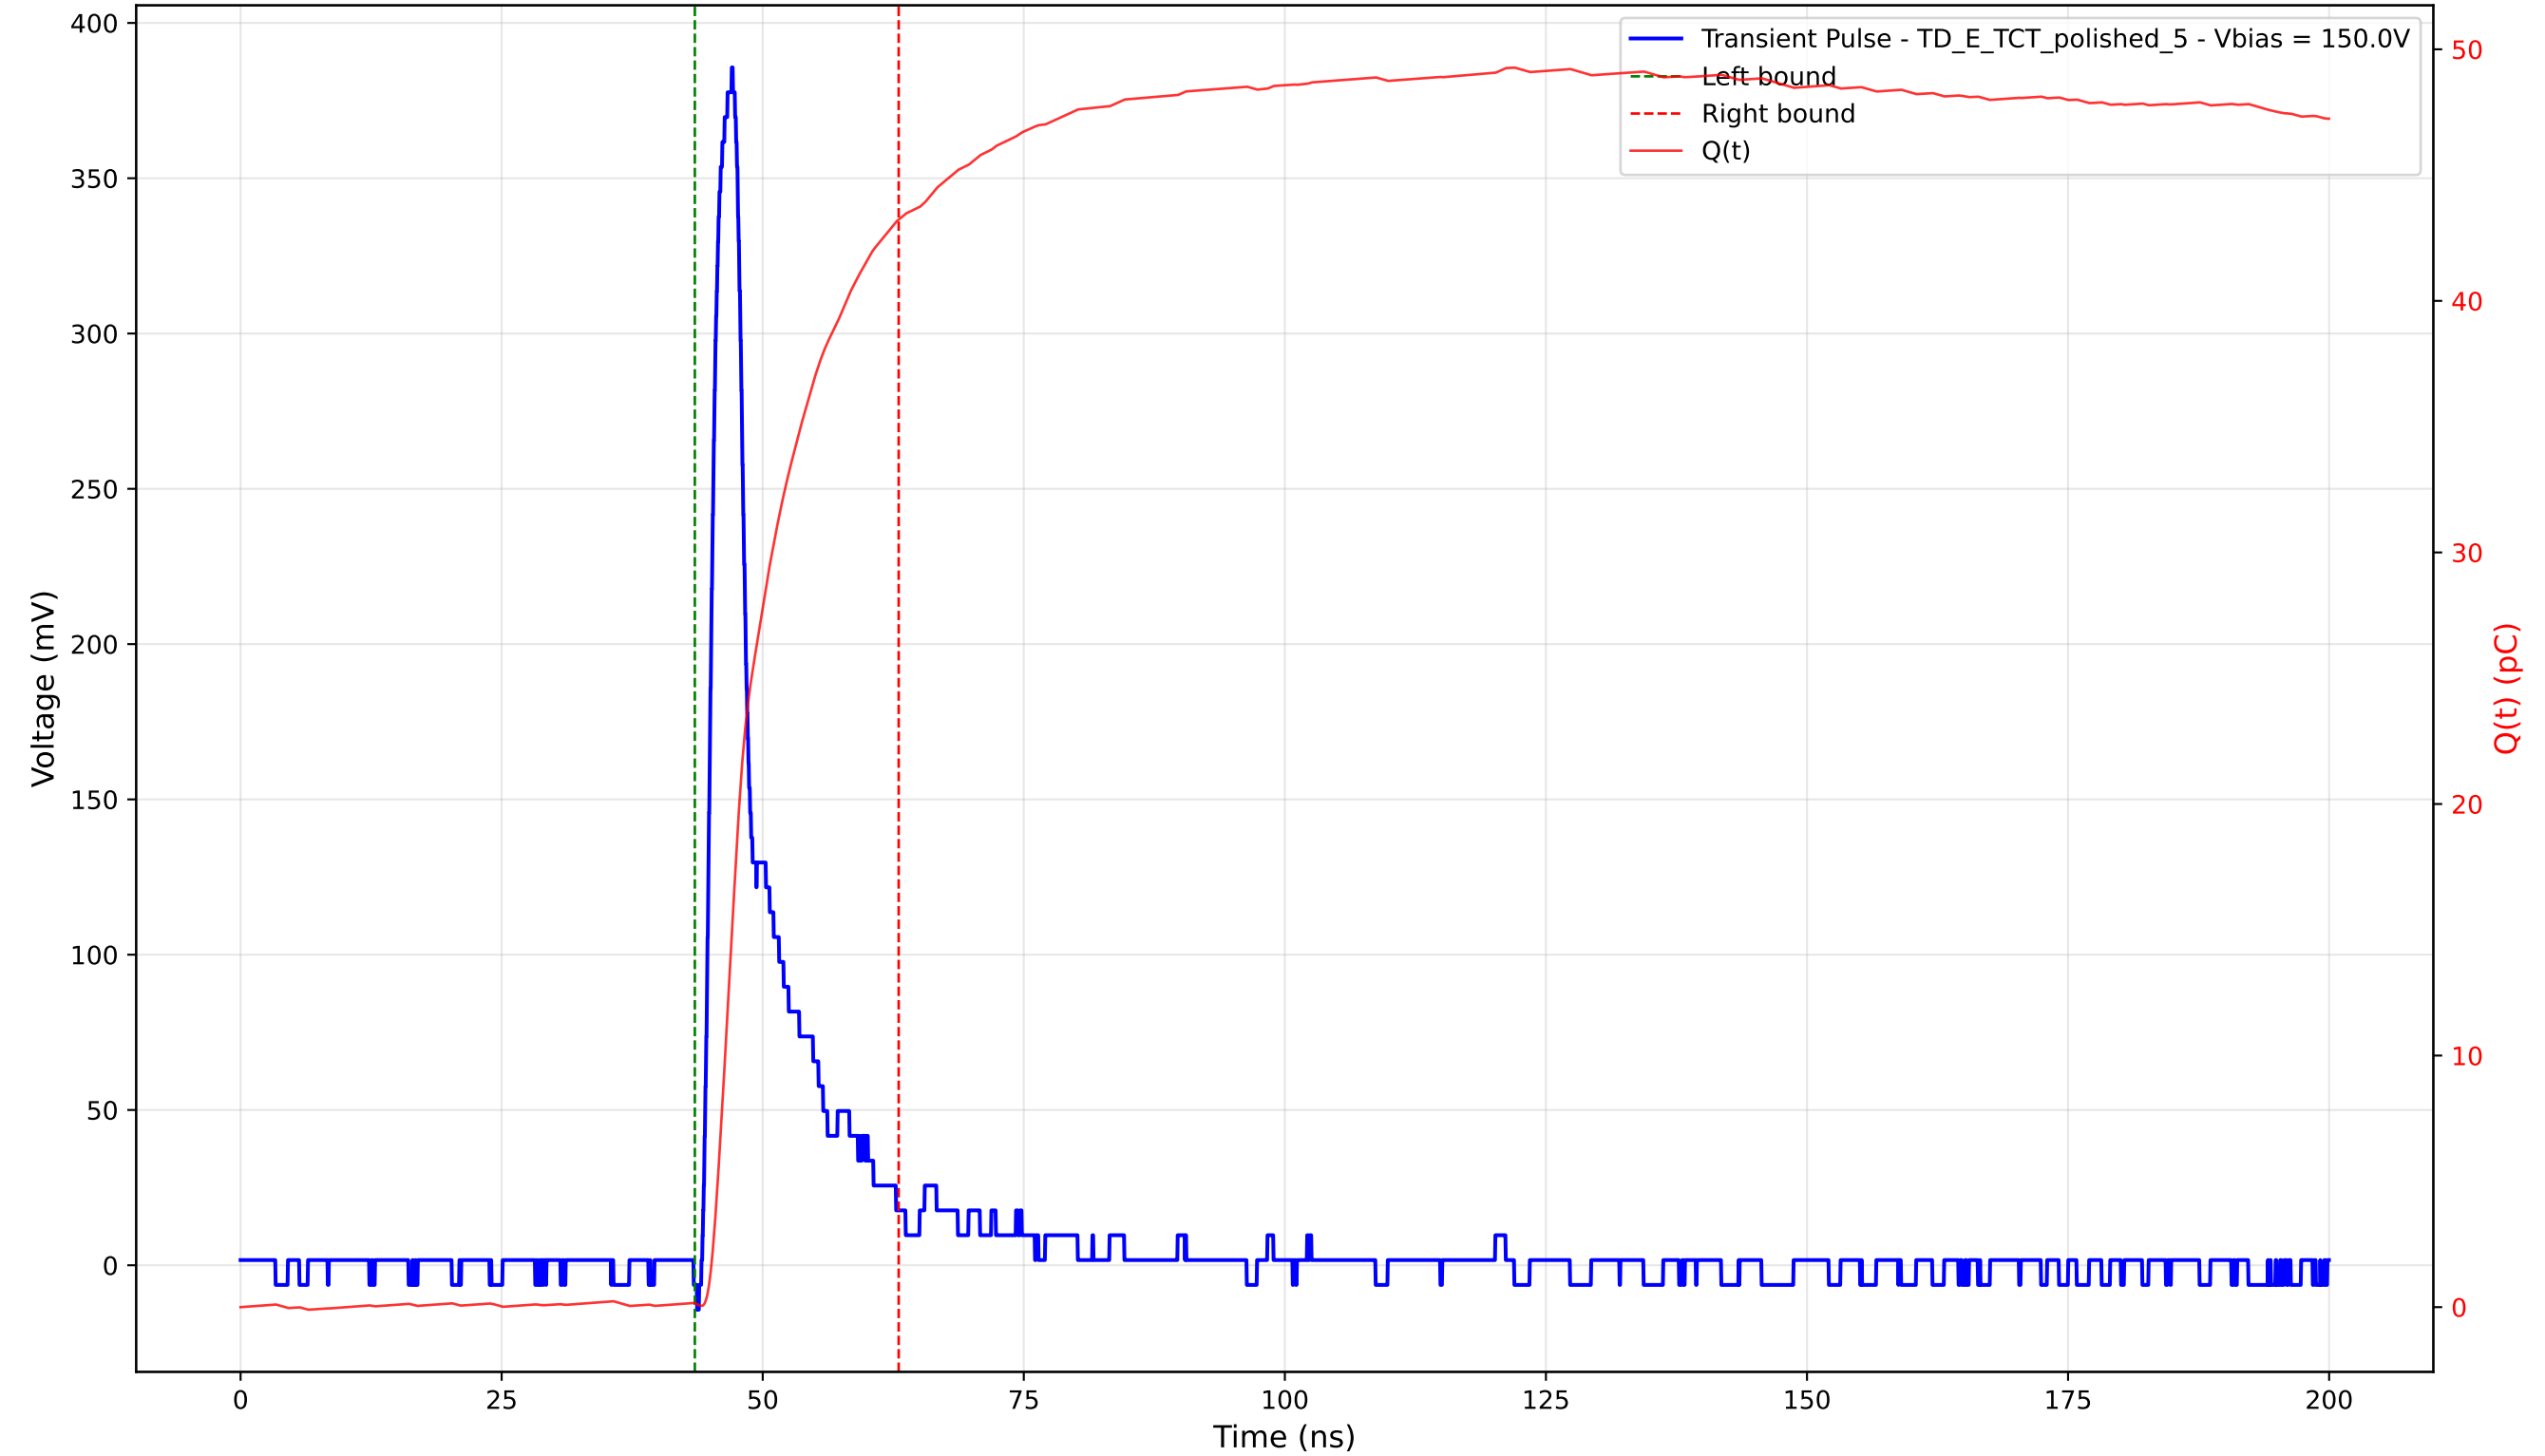


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 42.41 pC - Rise Time: 1.89 ns

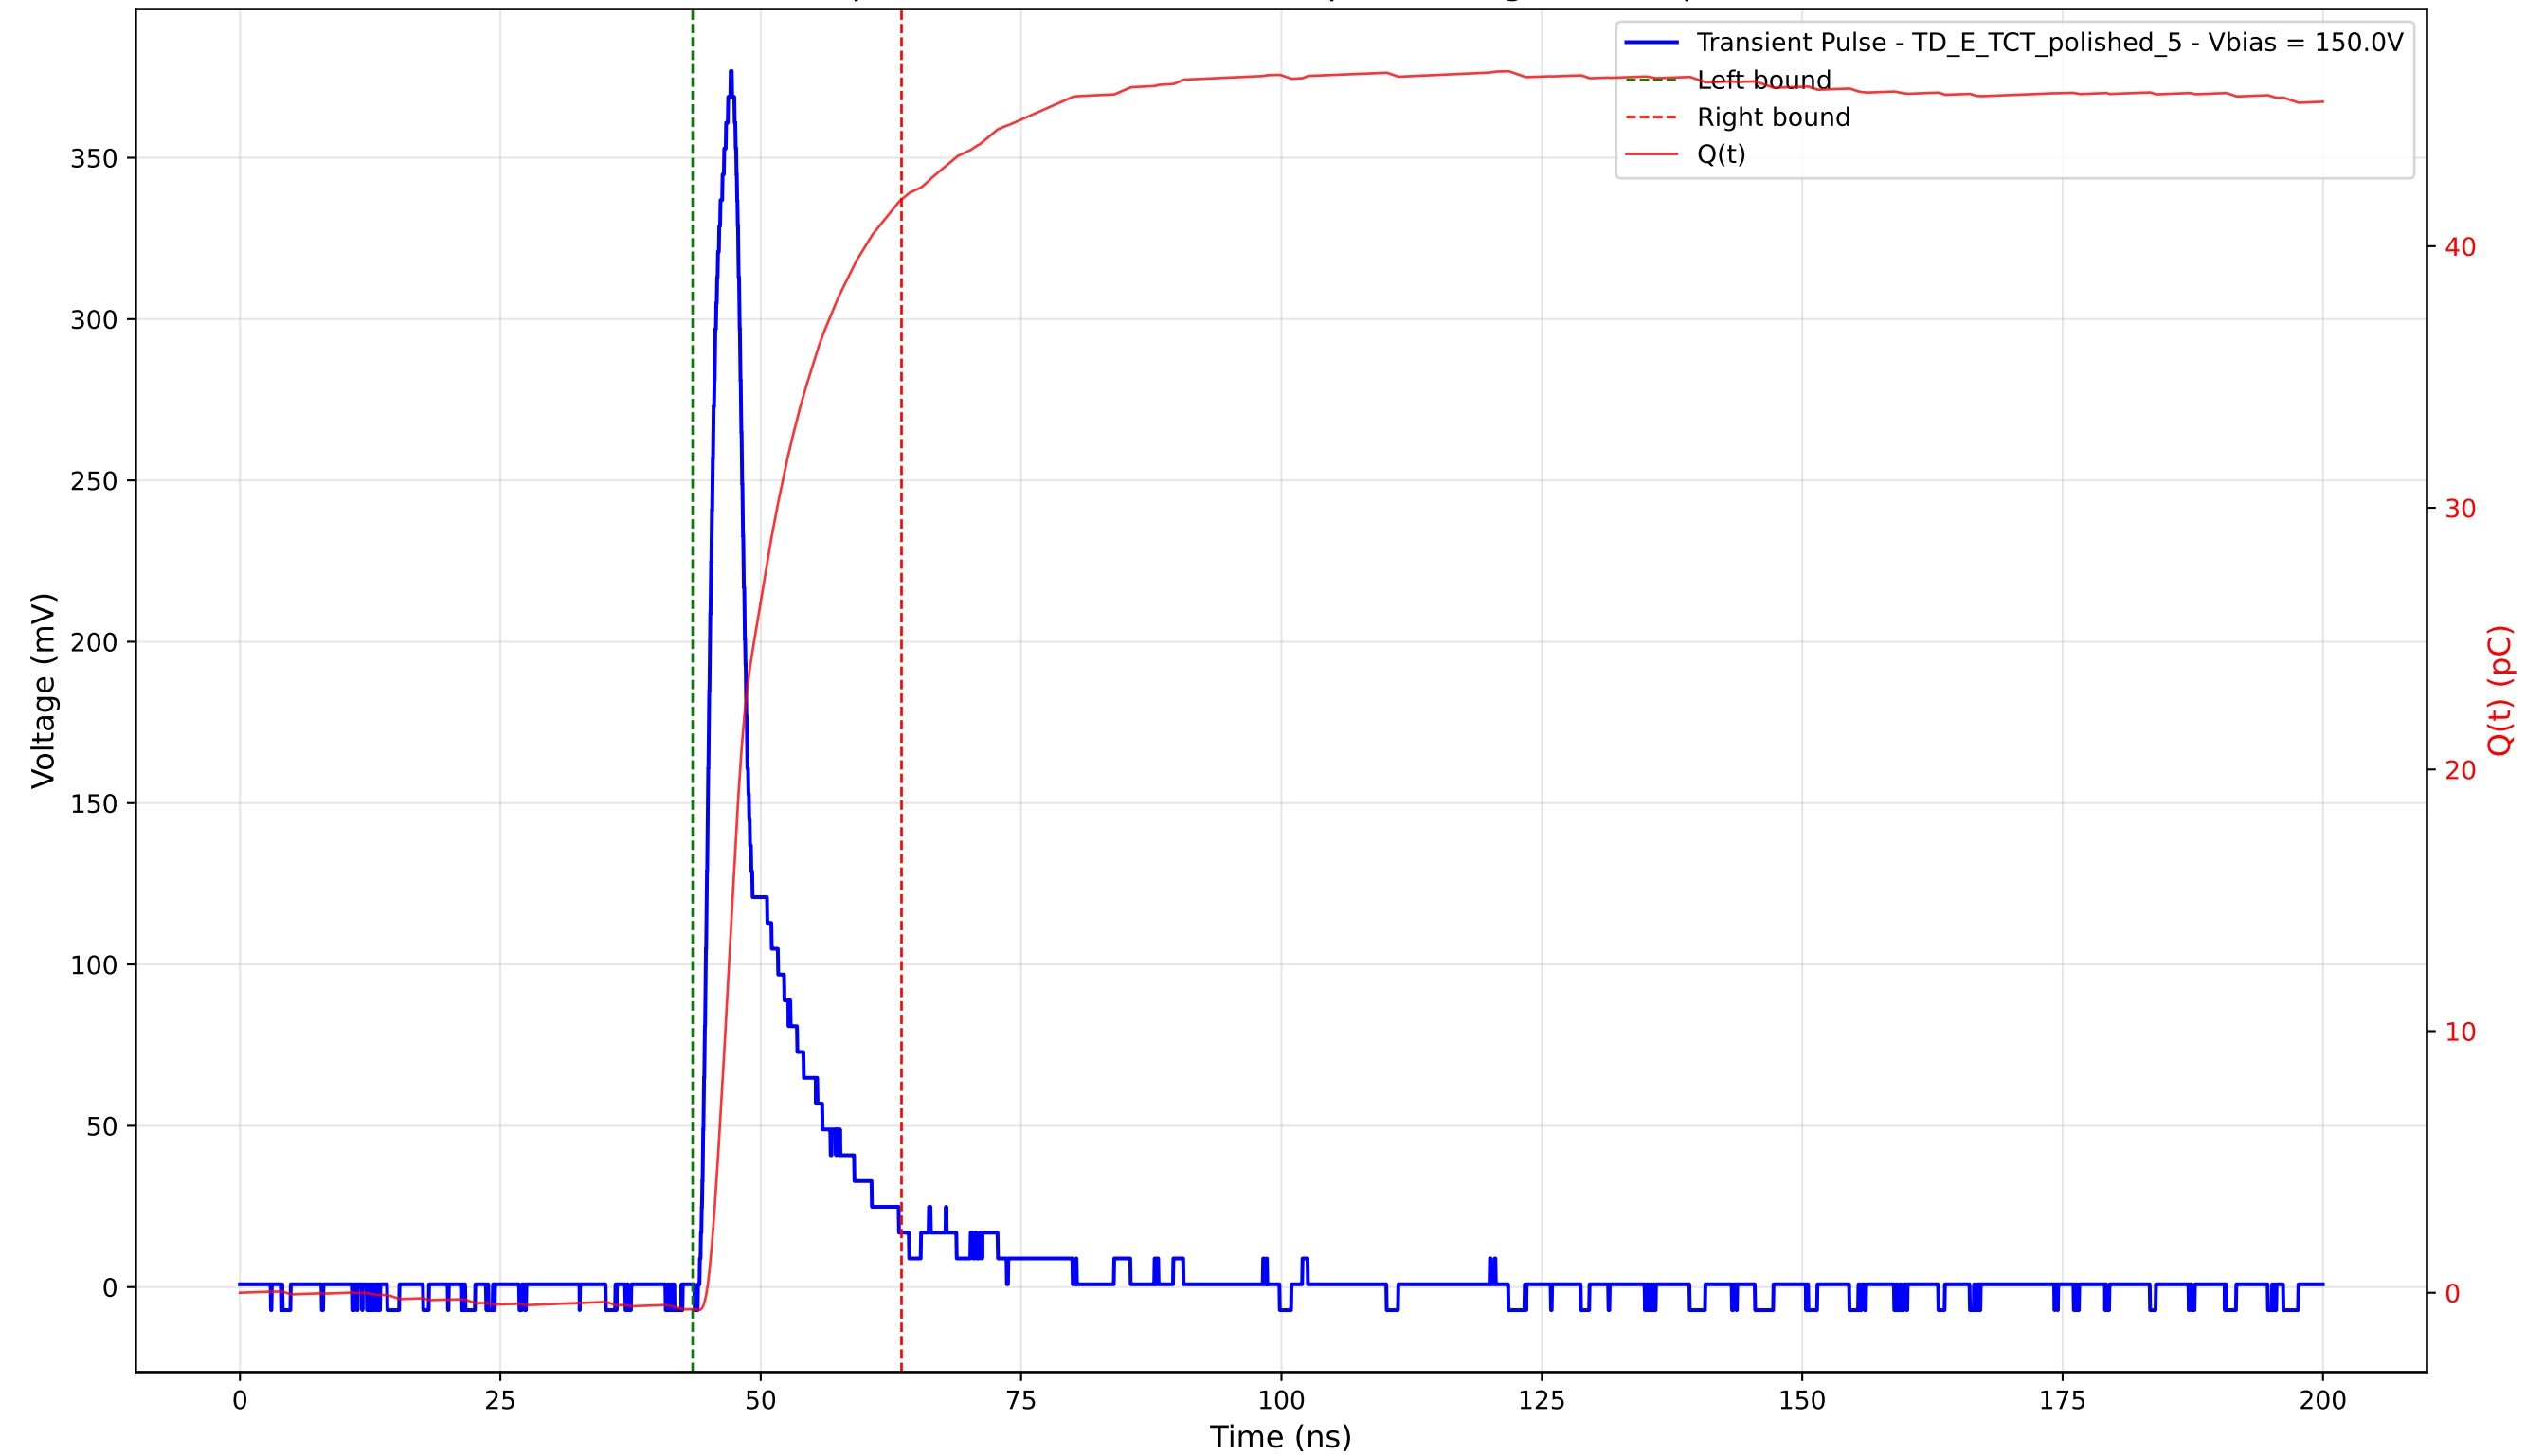


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 41.65 pC - Rise Time: 1.91 ns

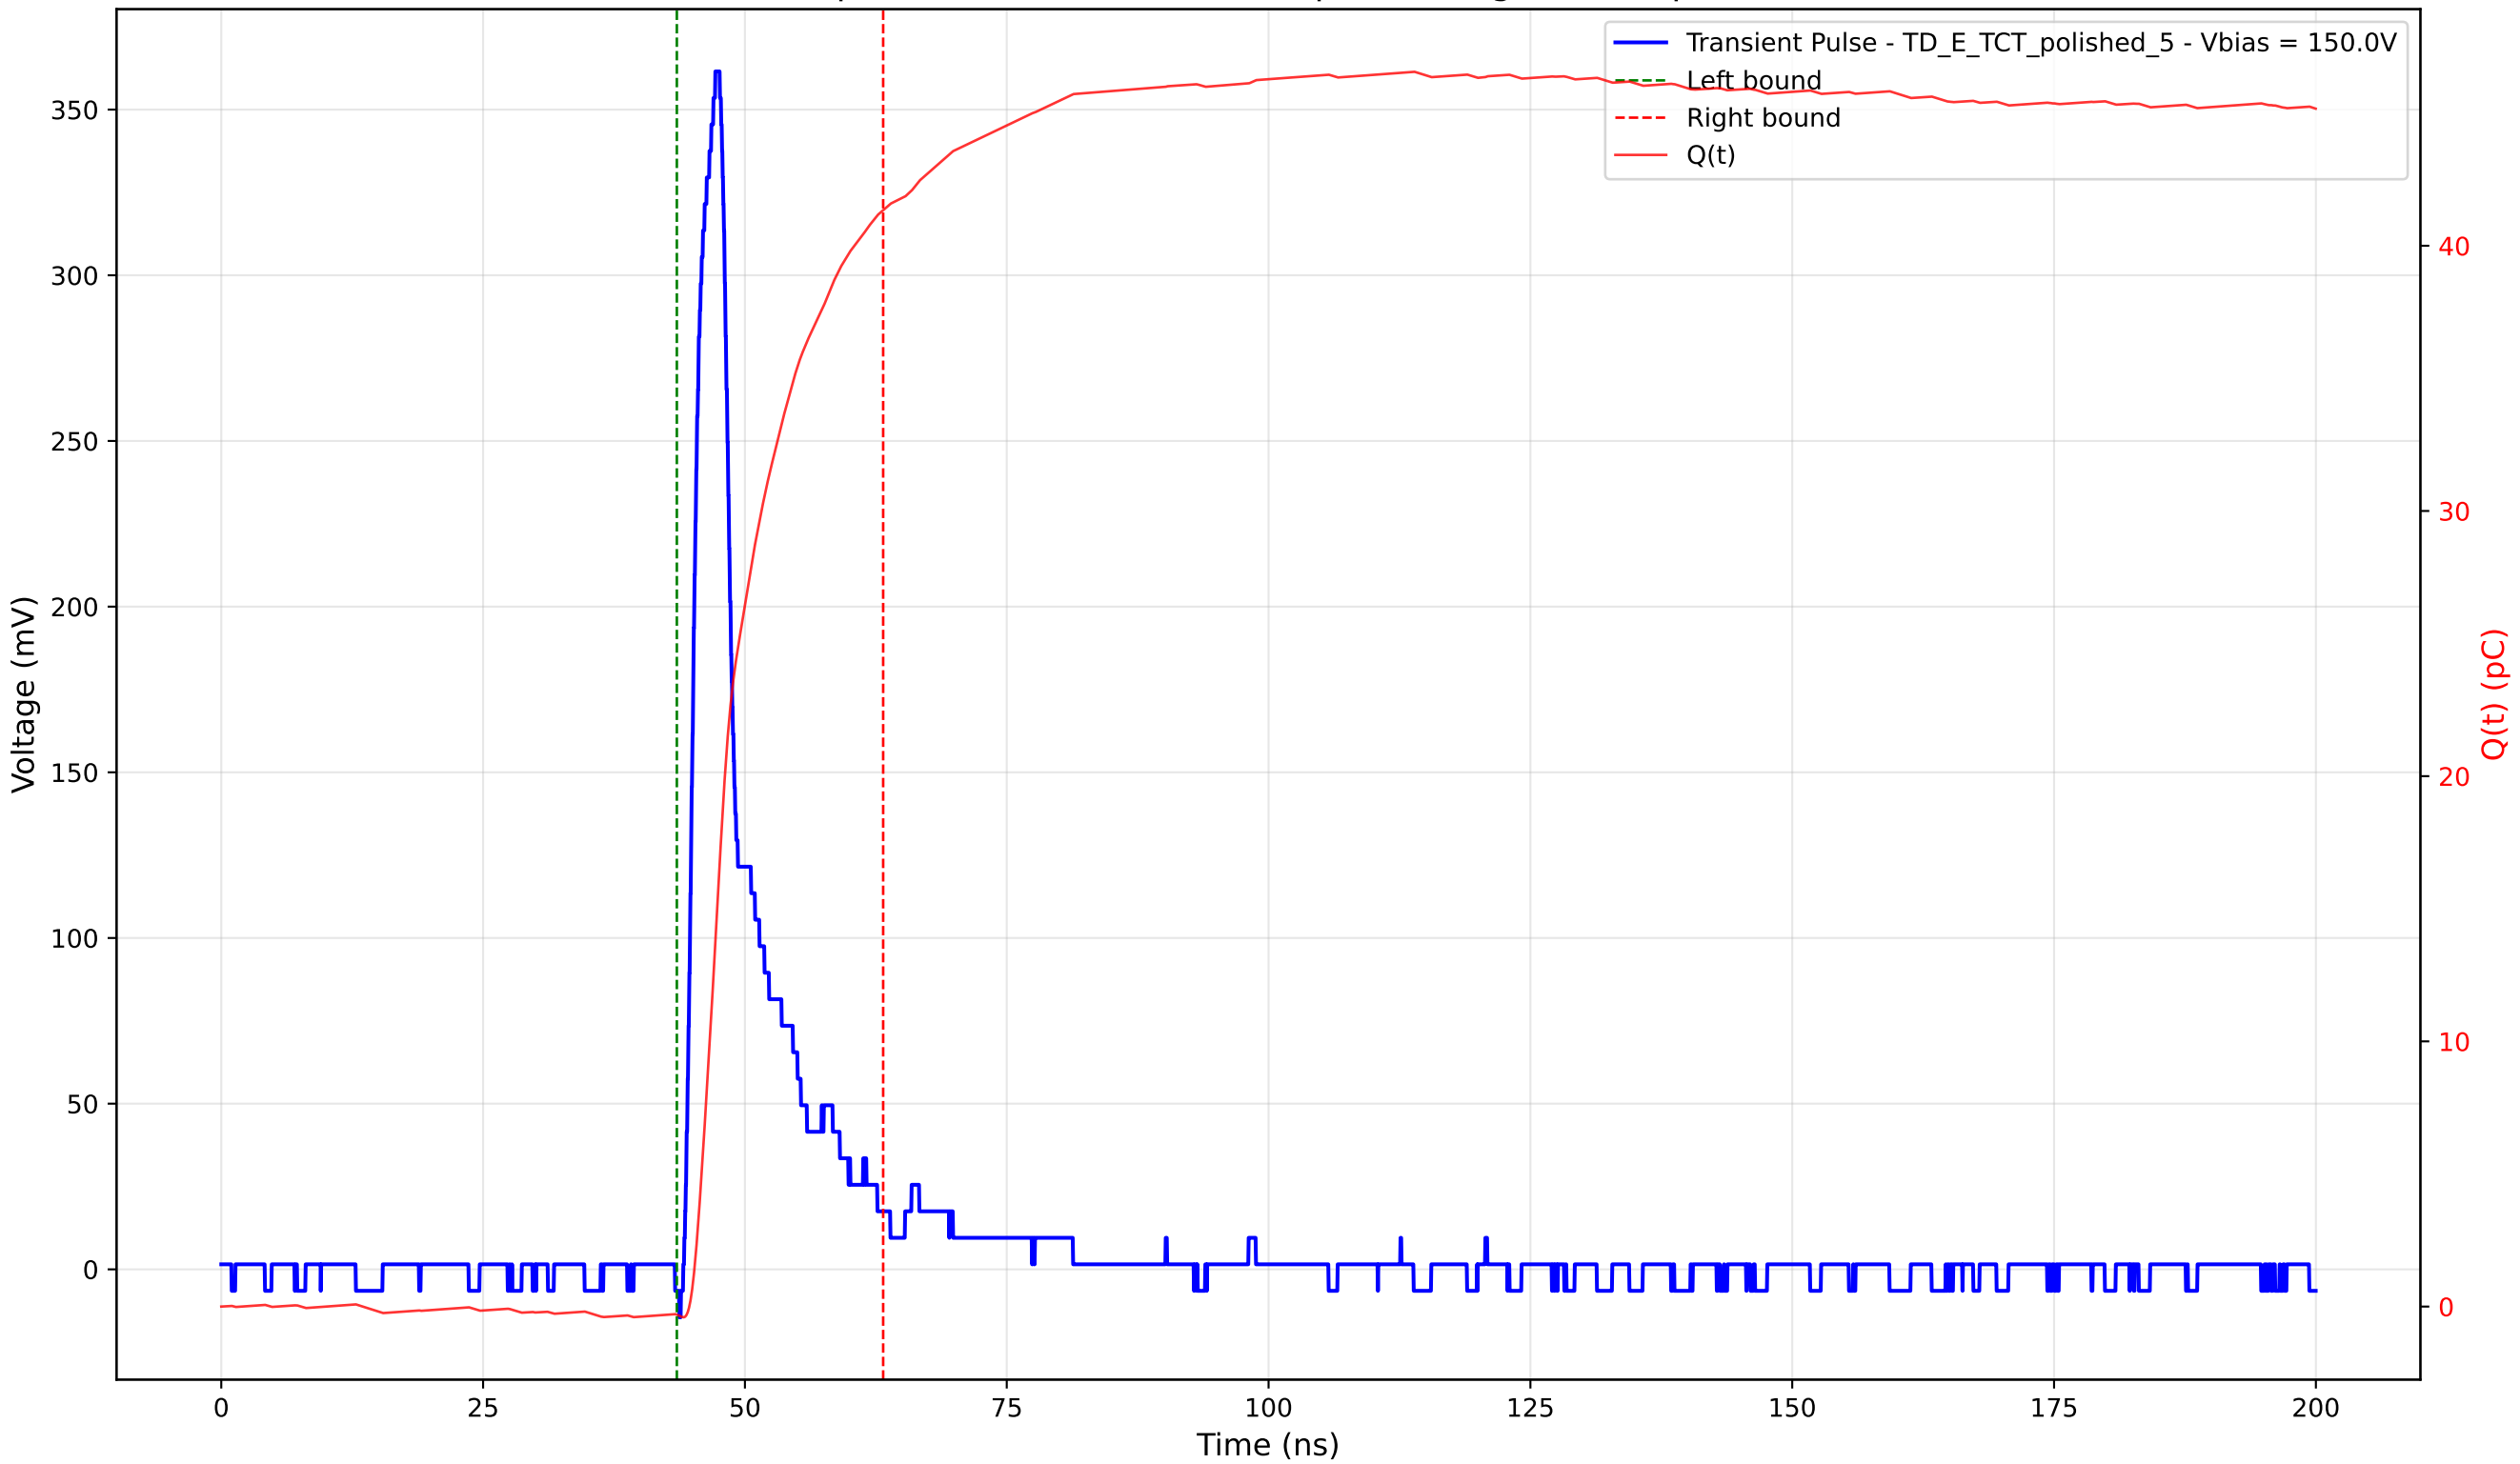


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 40.27 pC - Rise Time: 2.35 ns

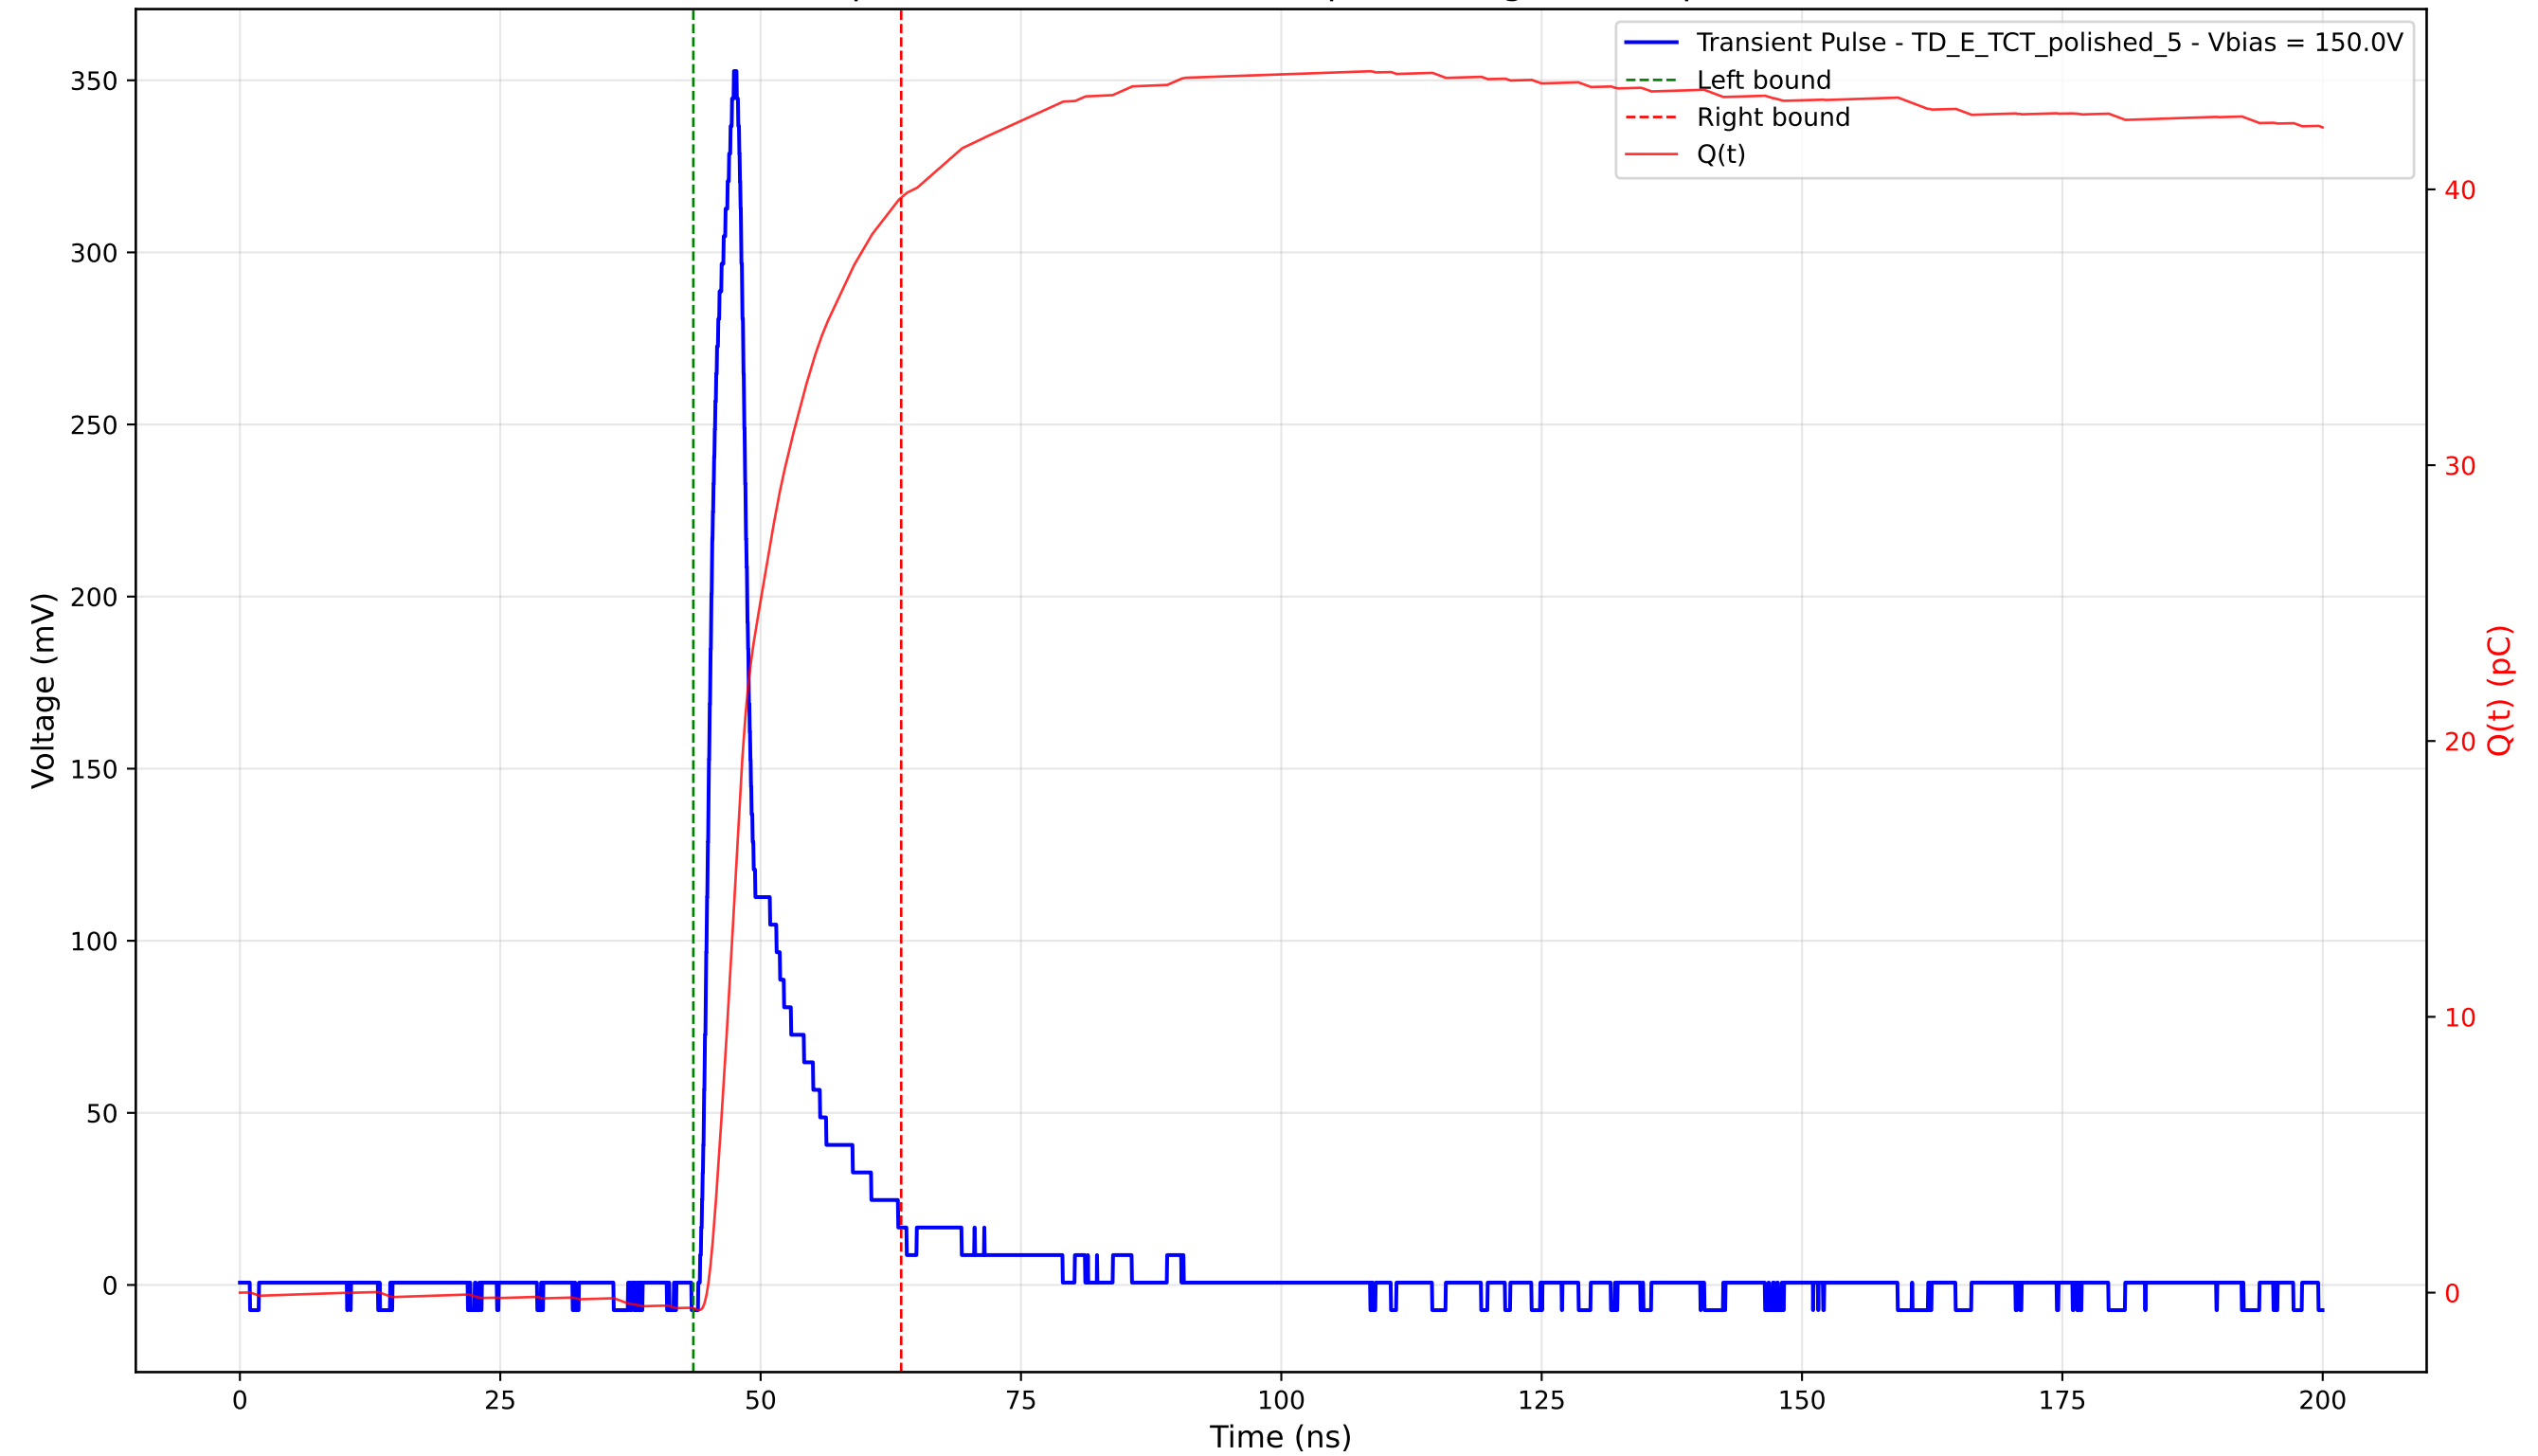


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 39.39 pC - Rise Time: 2.42 ns

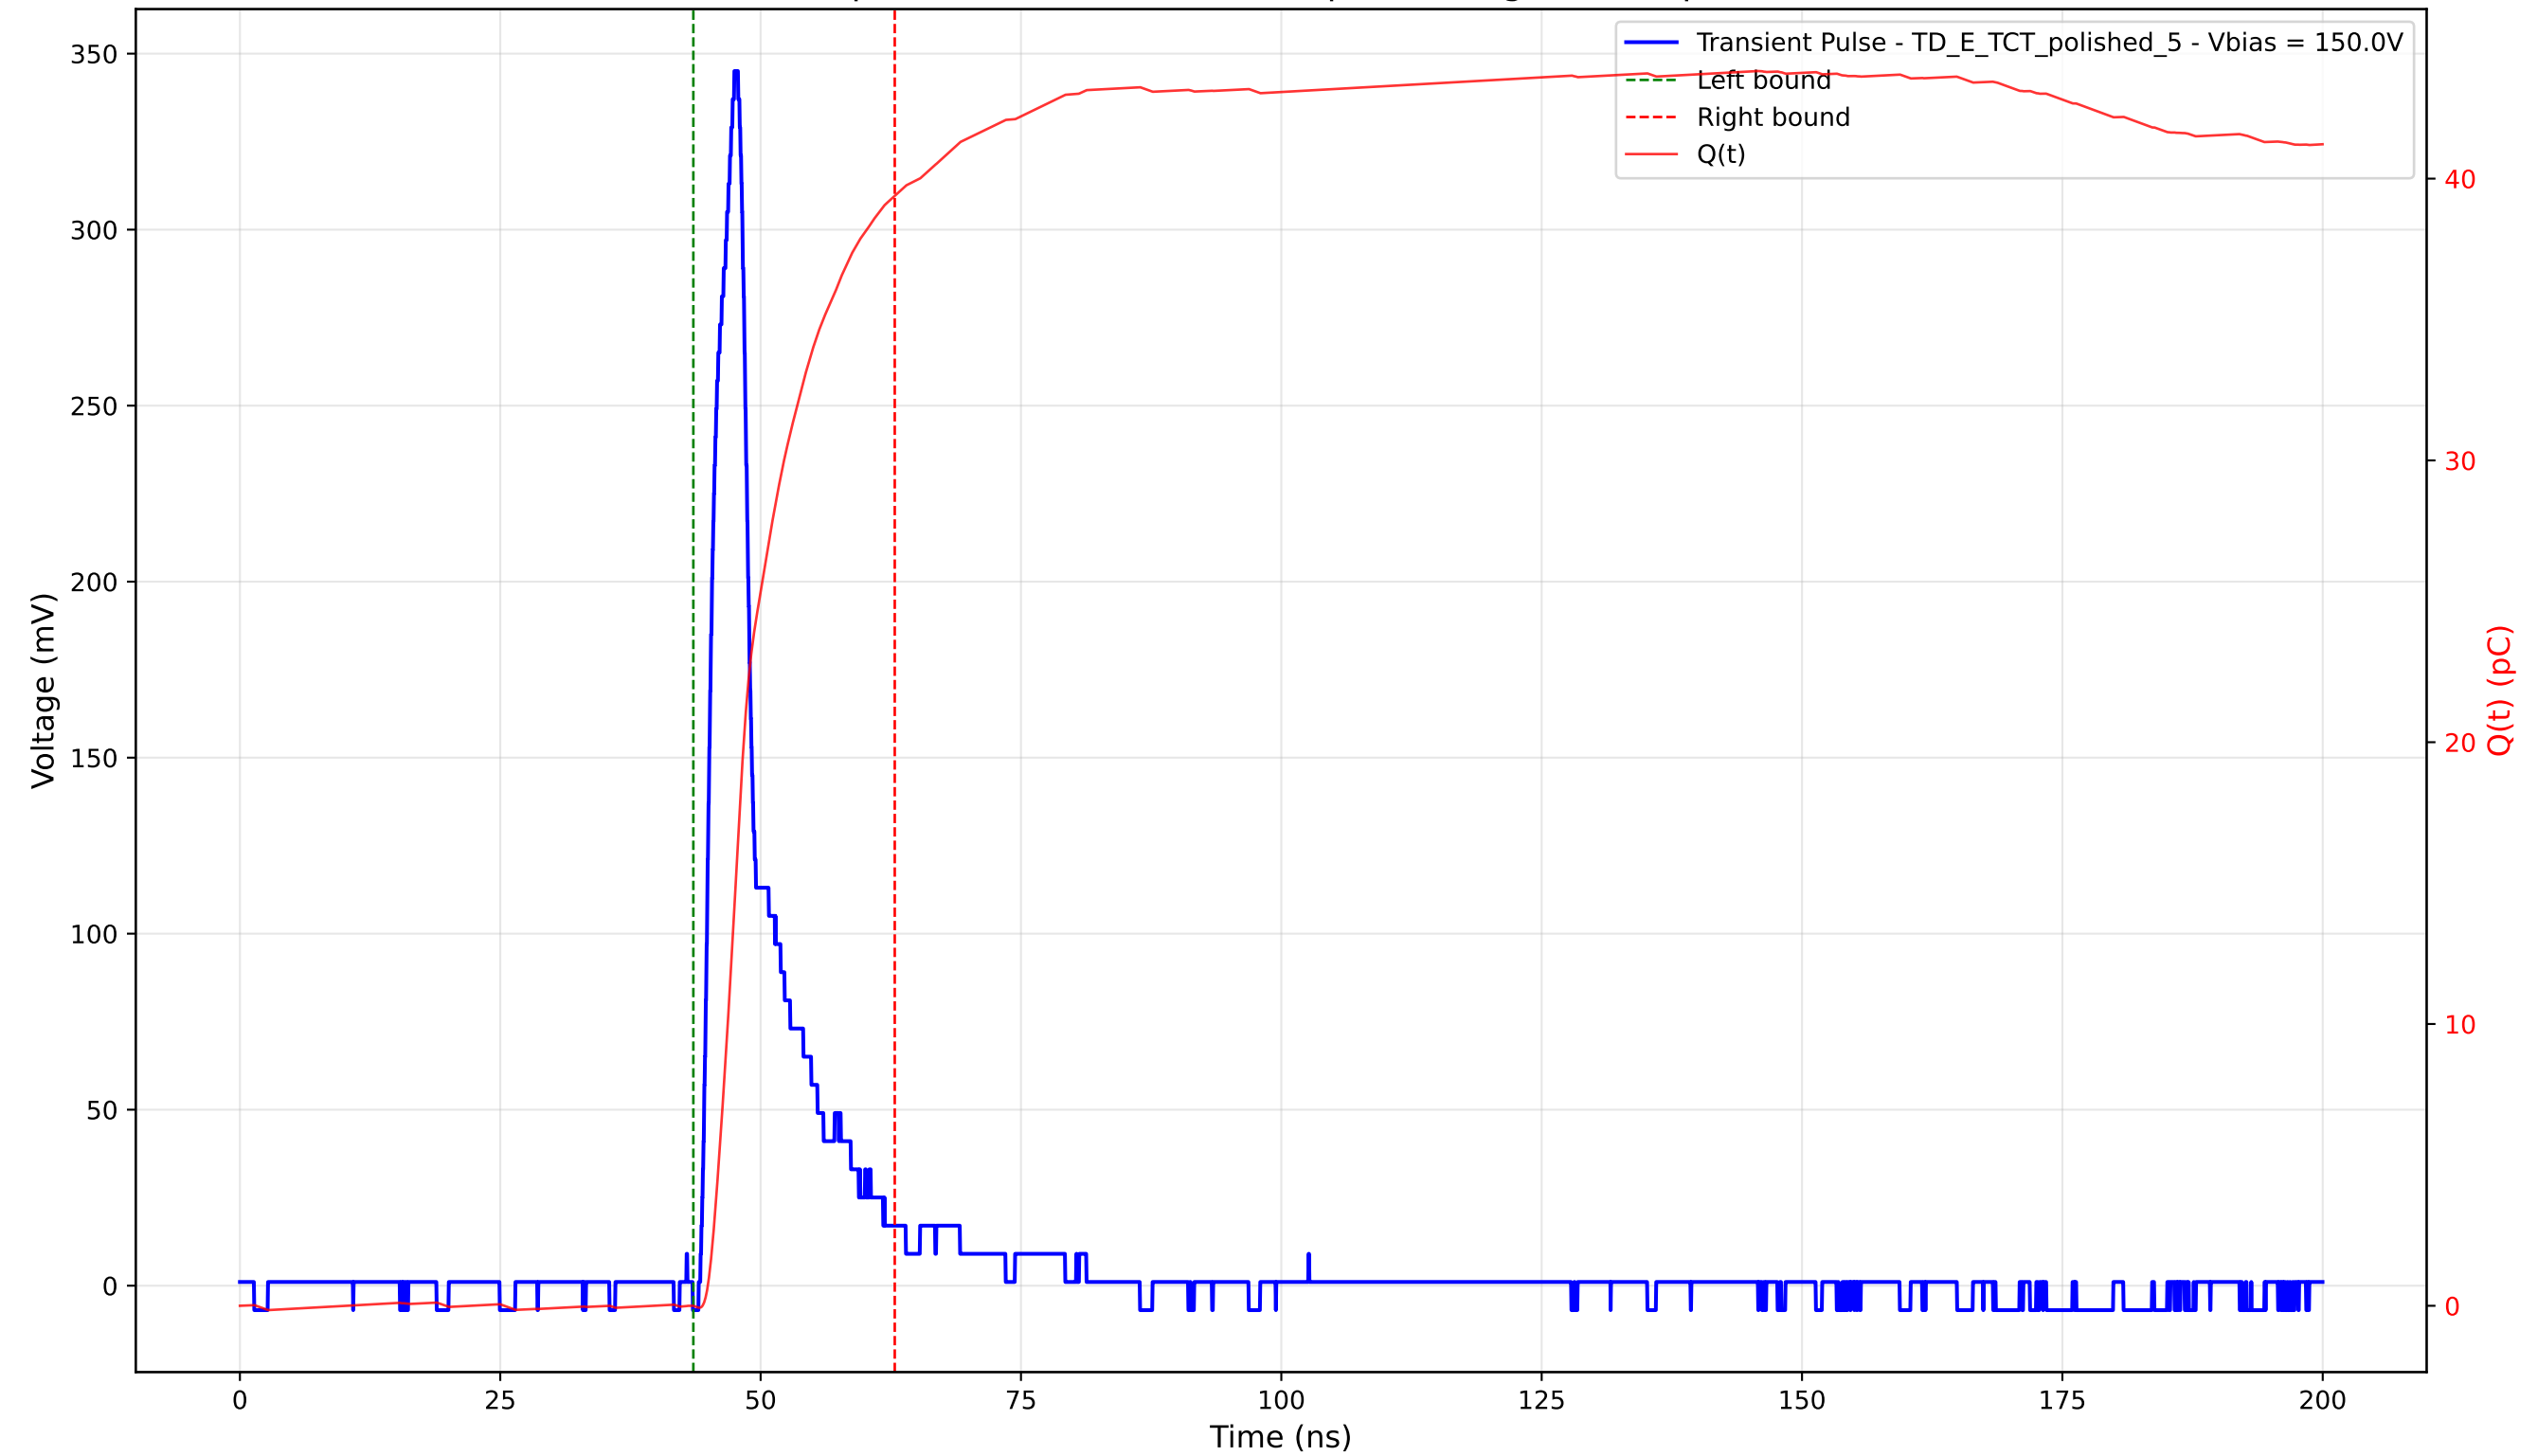


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 38.98 pC - Rise Time: 2.68 ns

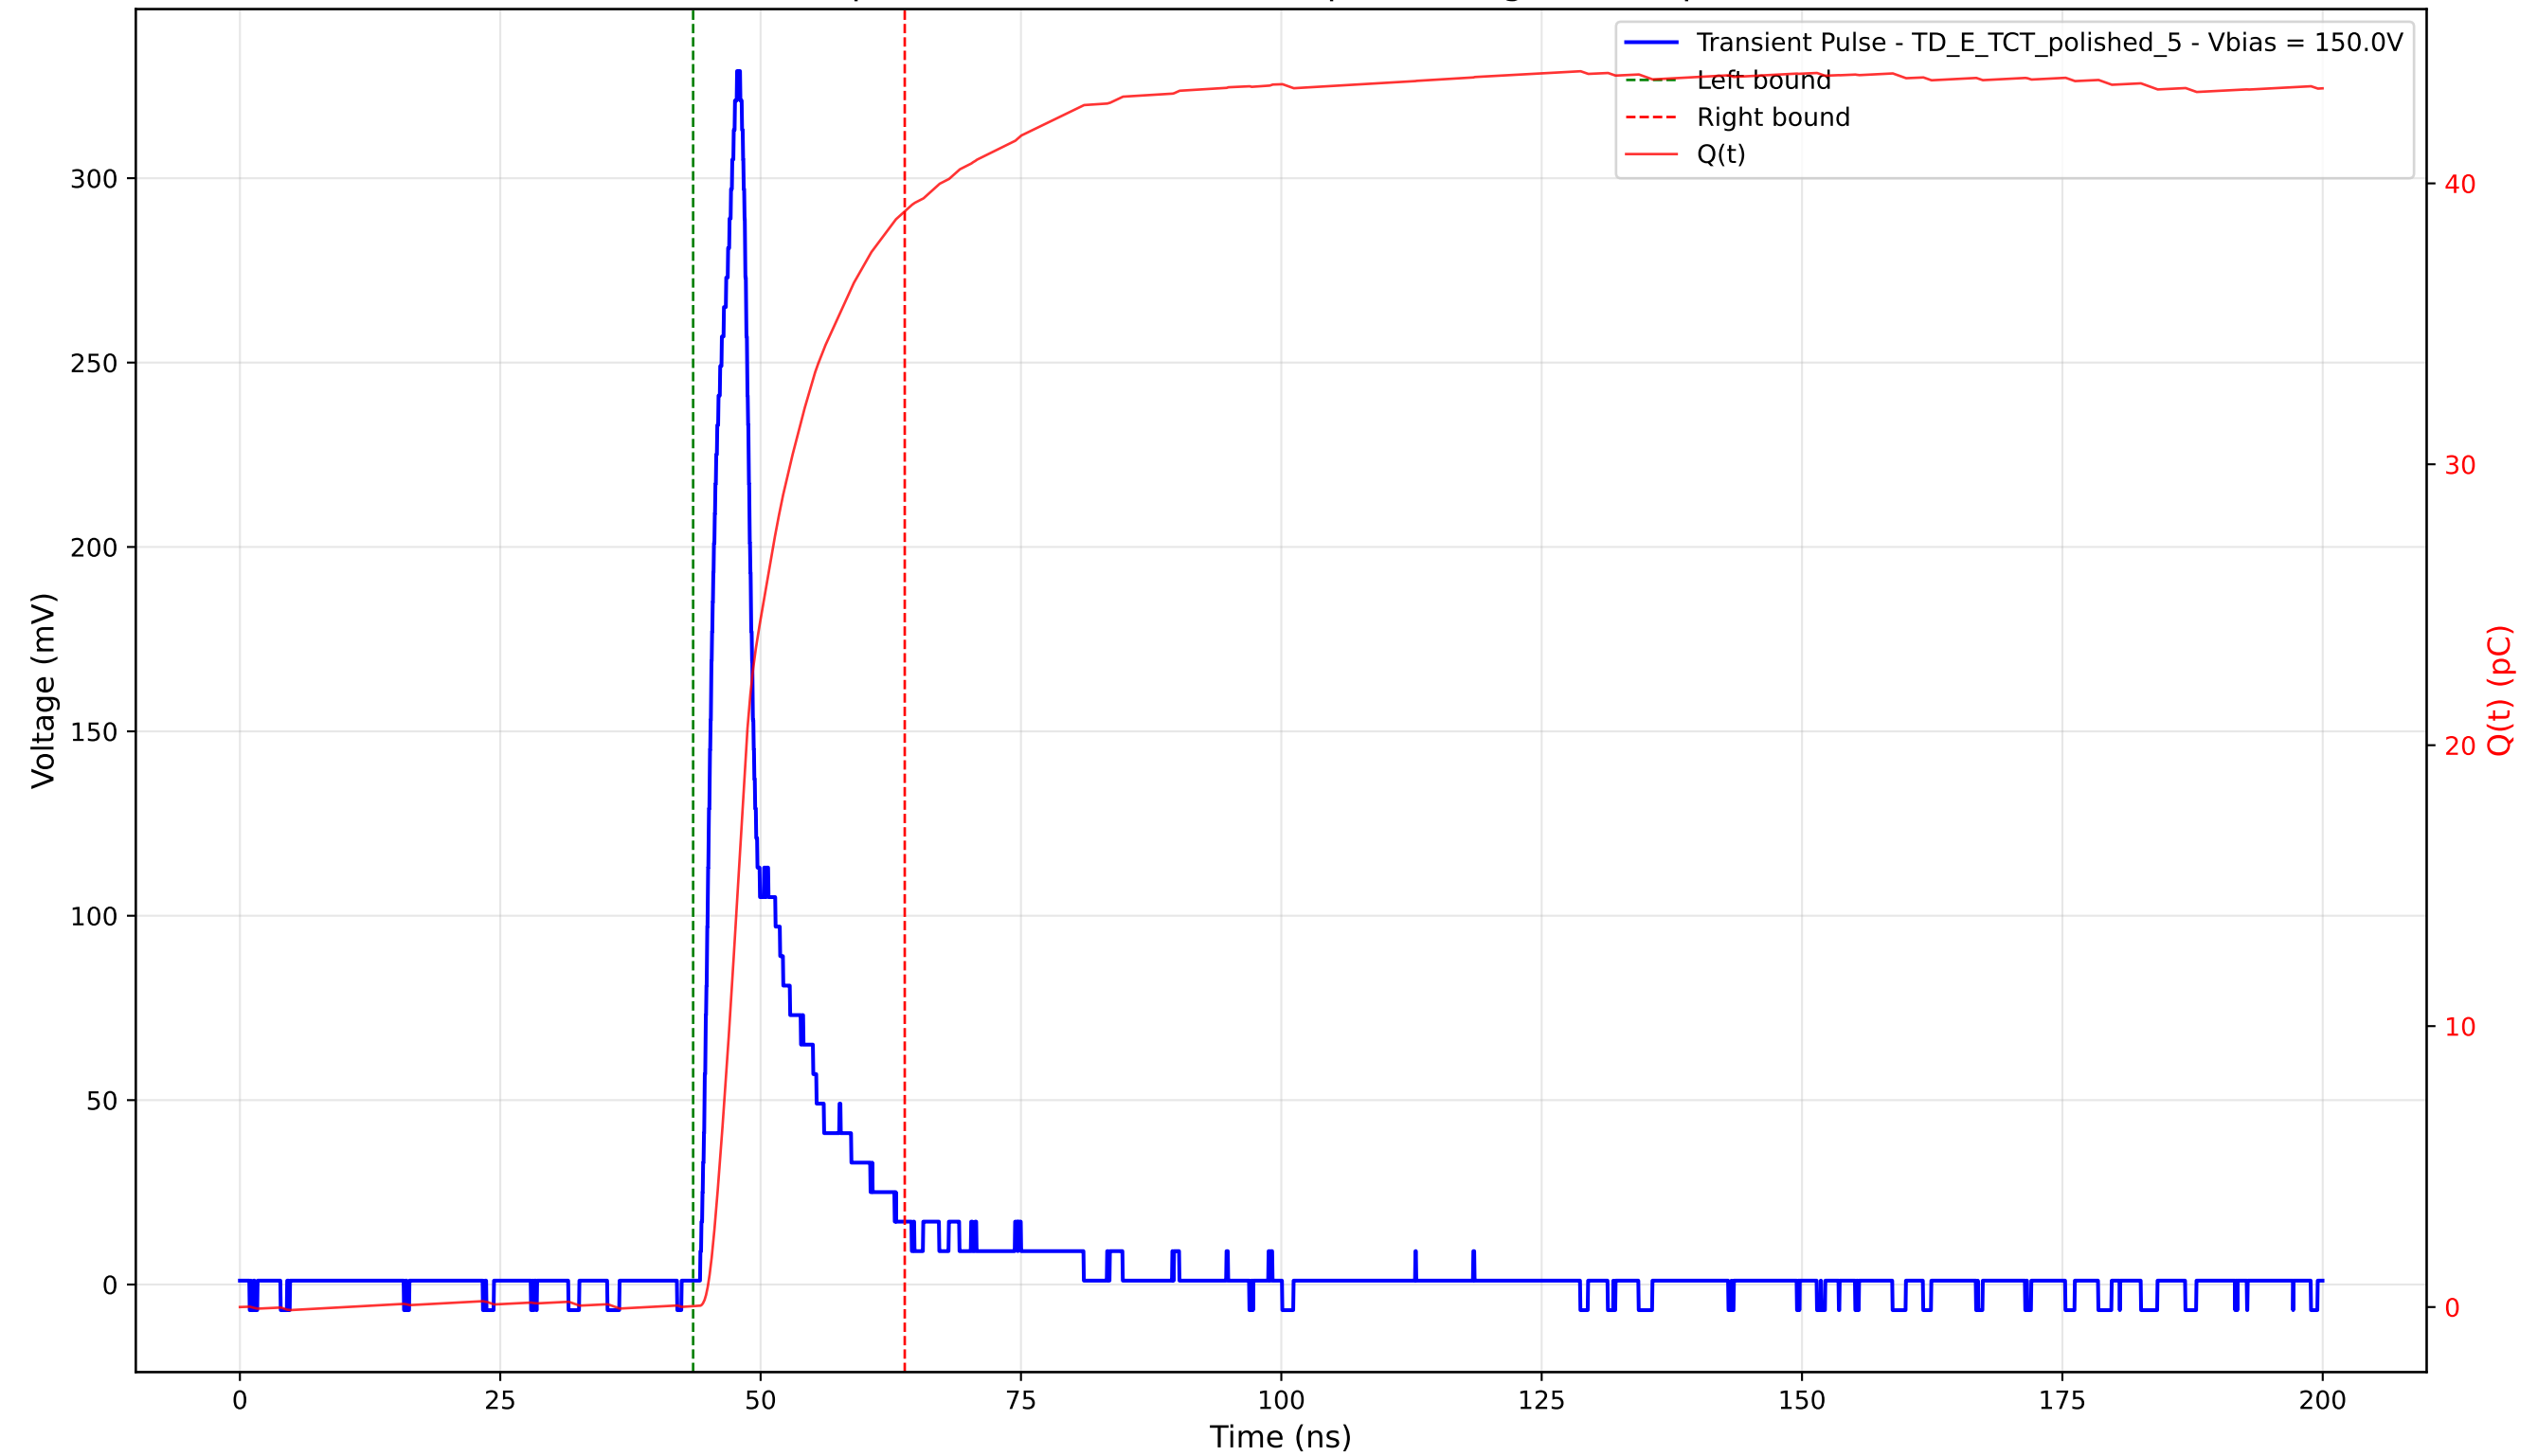


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 37.69 pC - Rise Time: 3.00 ns

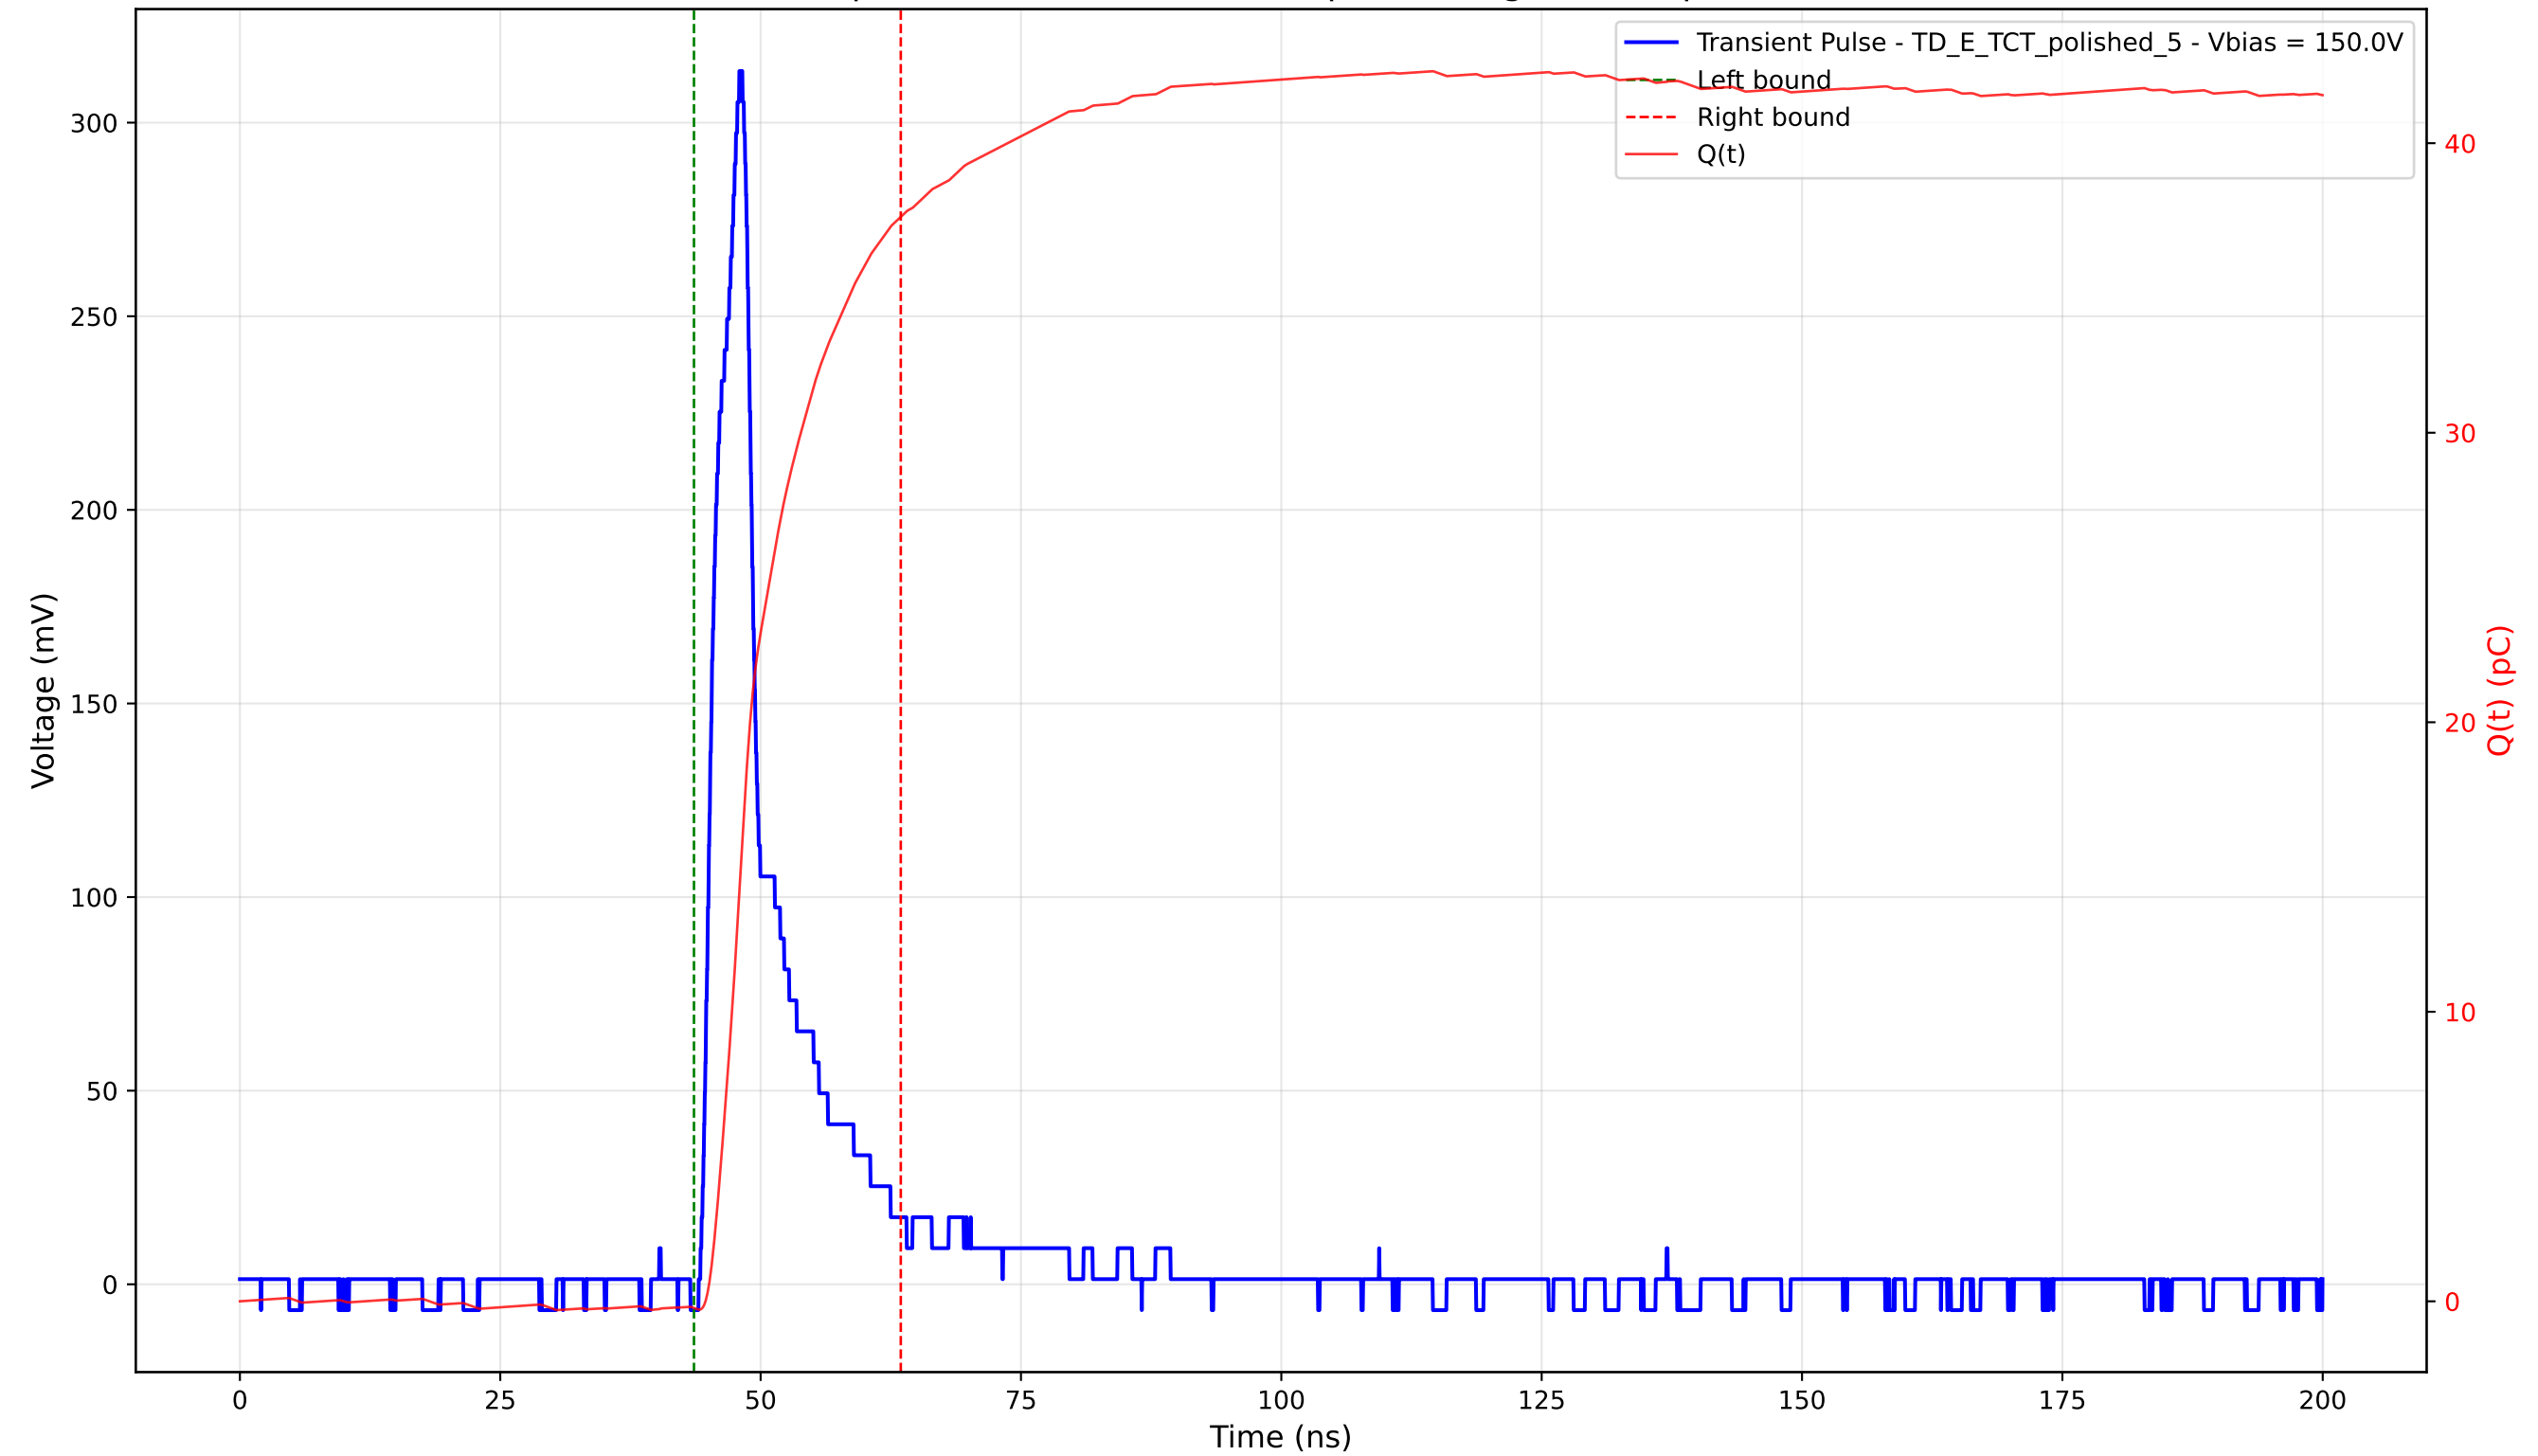


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 36.97 pC - Rise Time: 3.09 ns

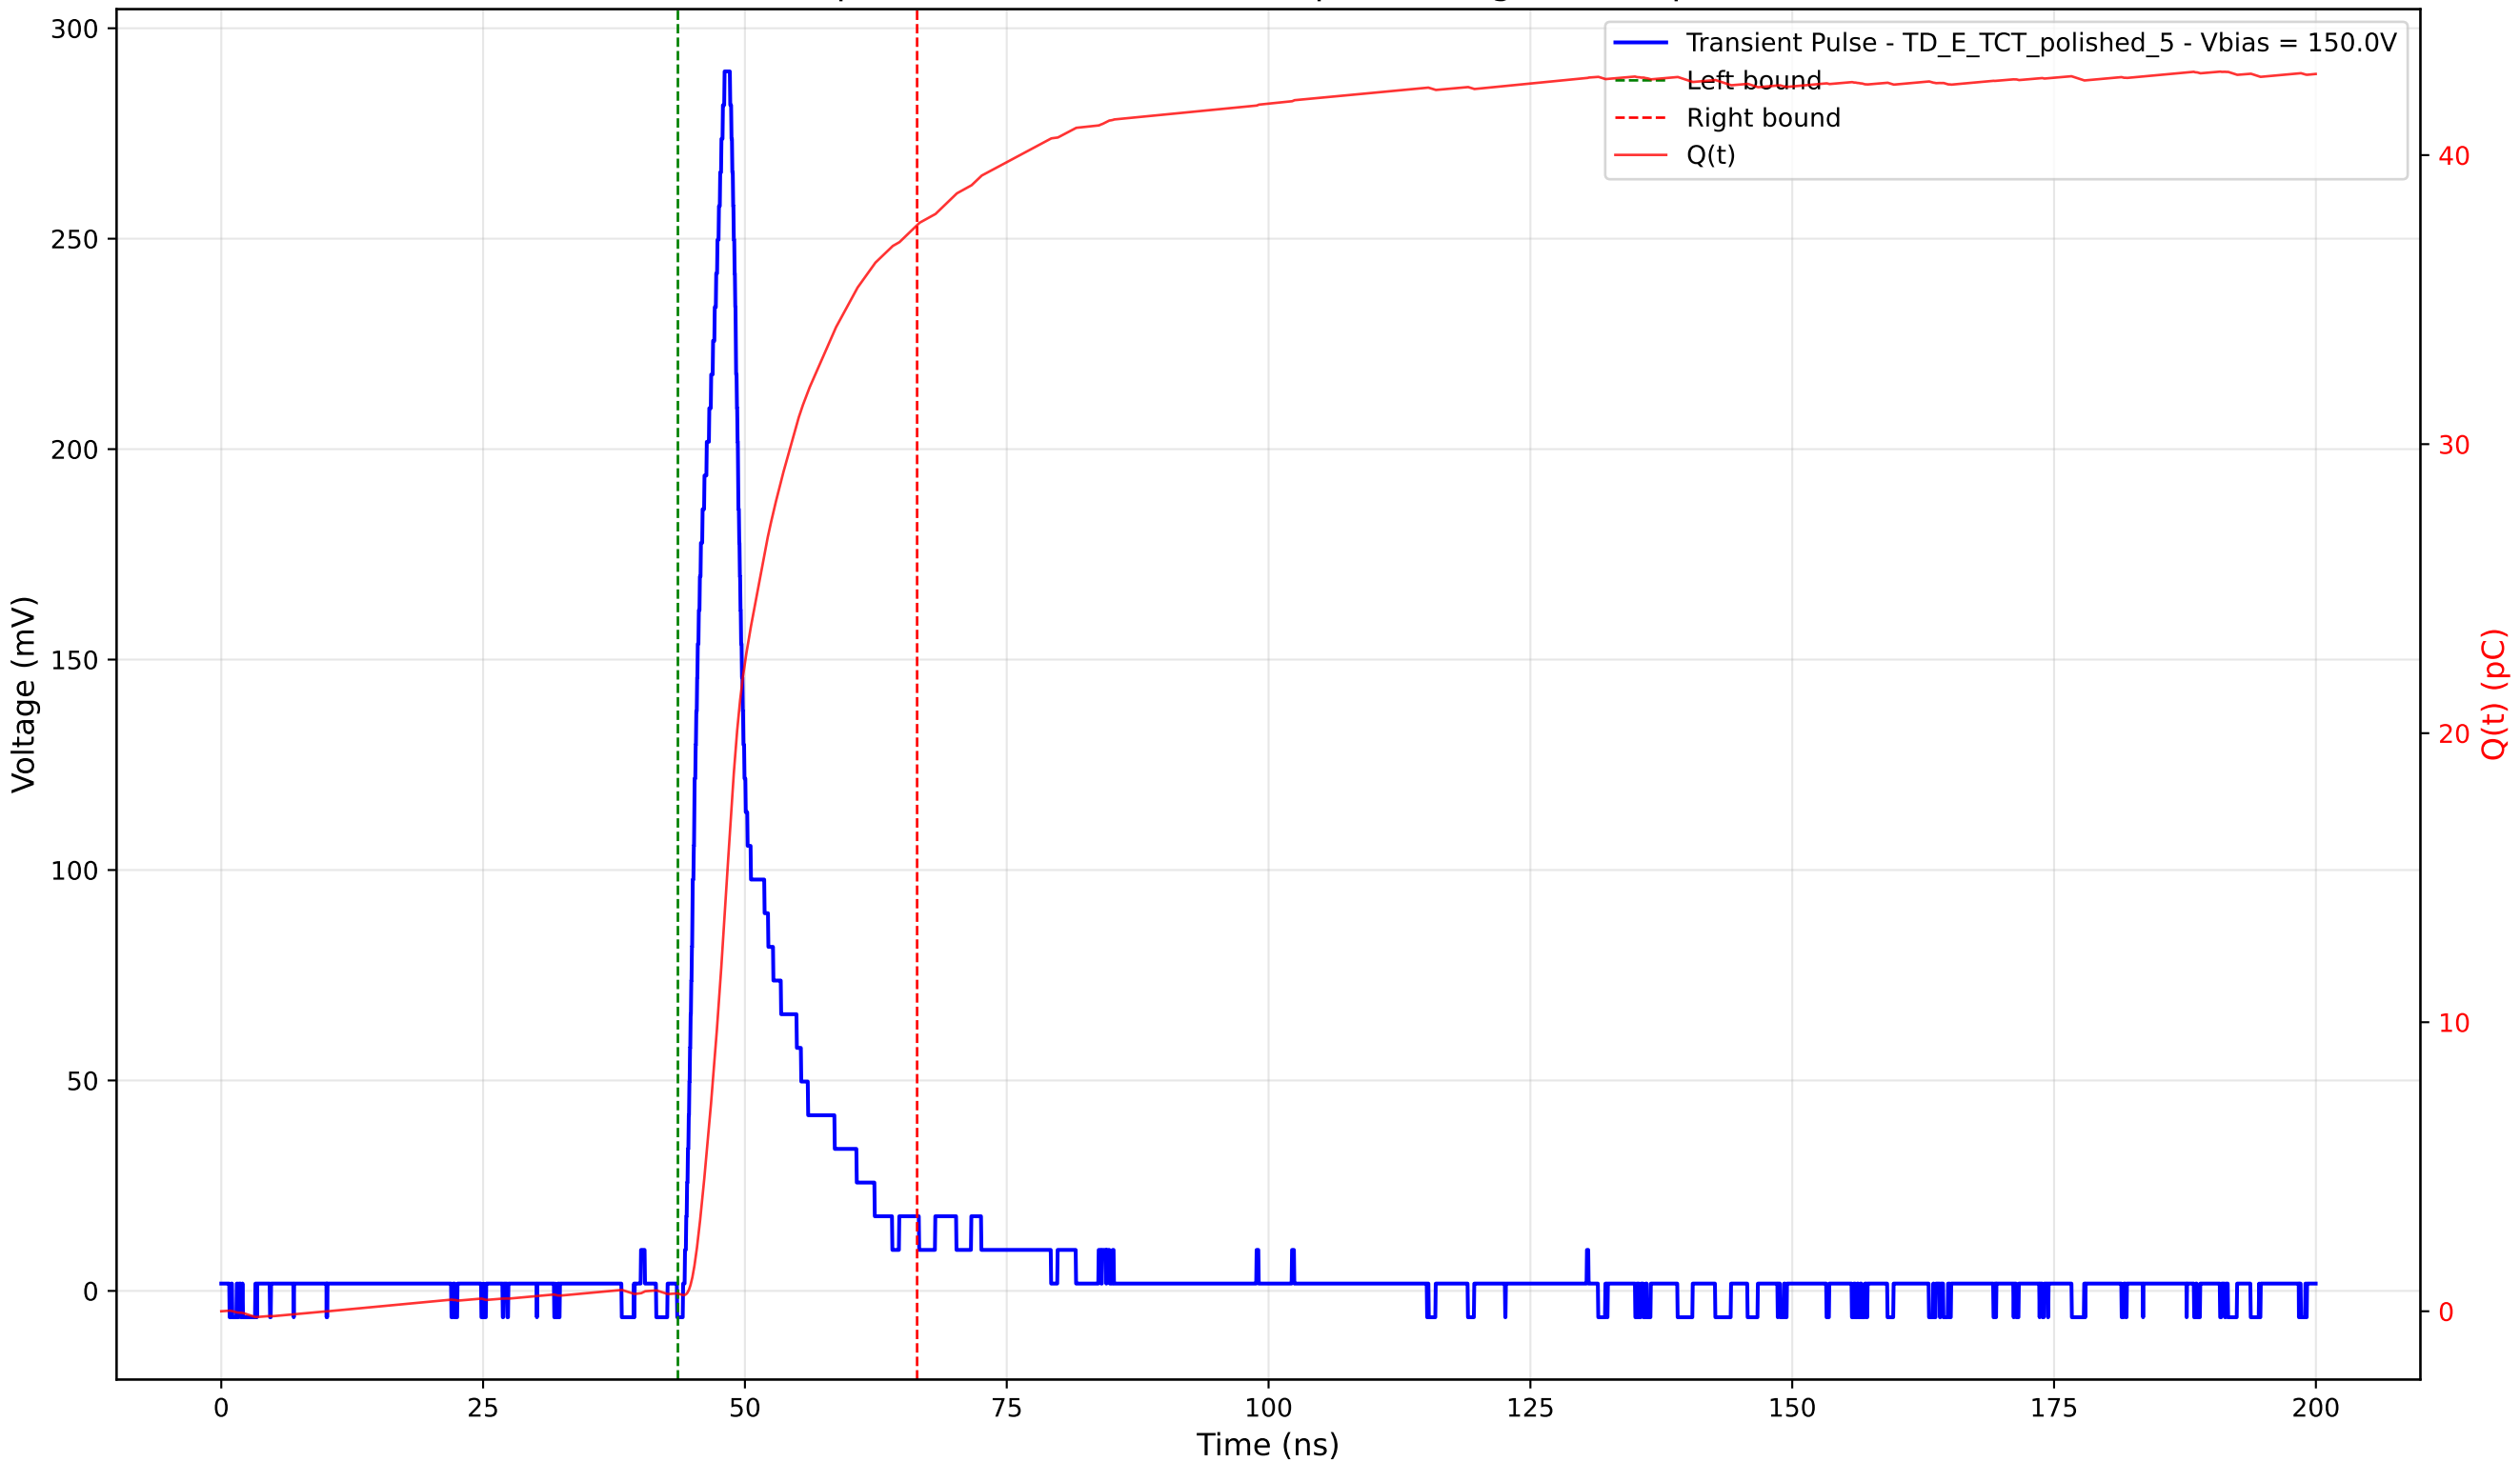


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 35.68 pC - Rise Time: 3.31 ns

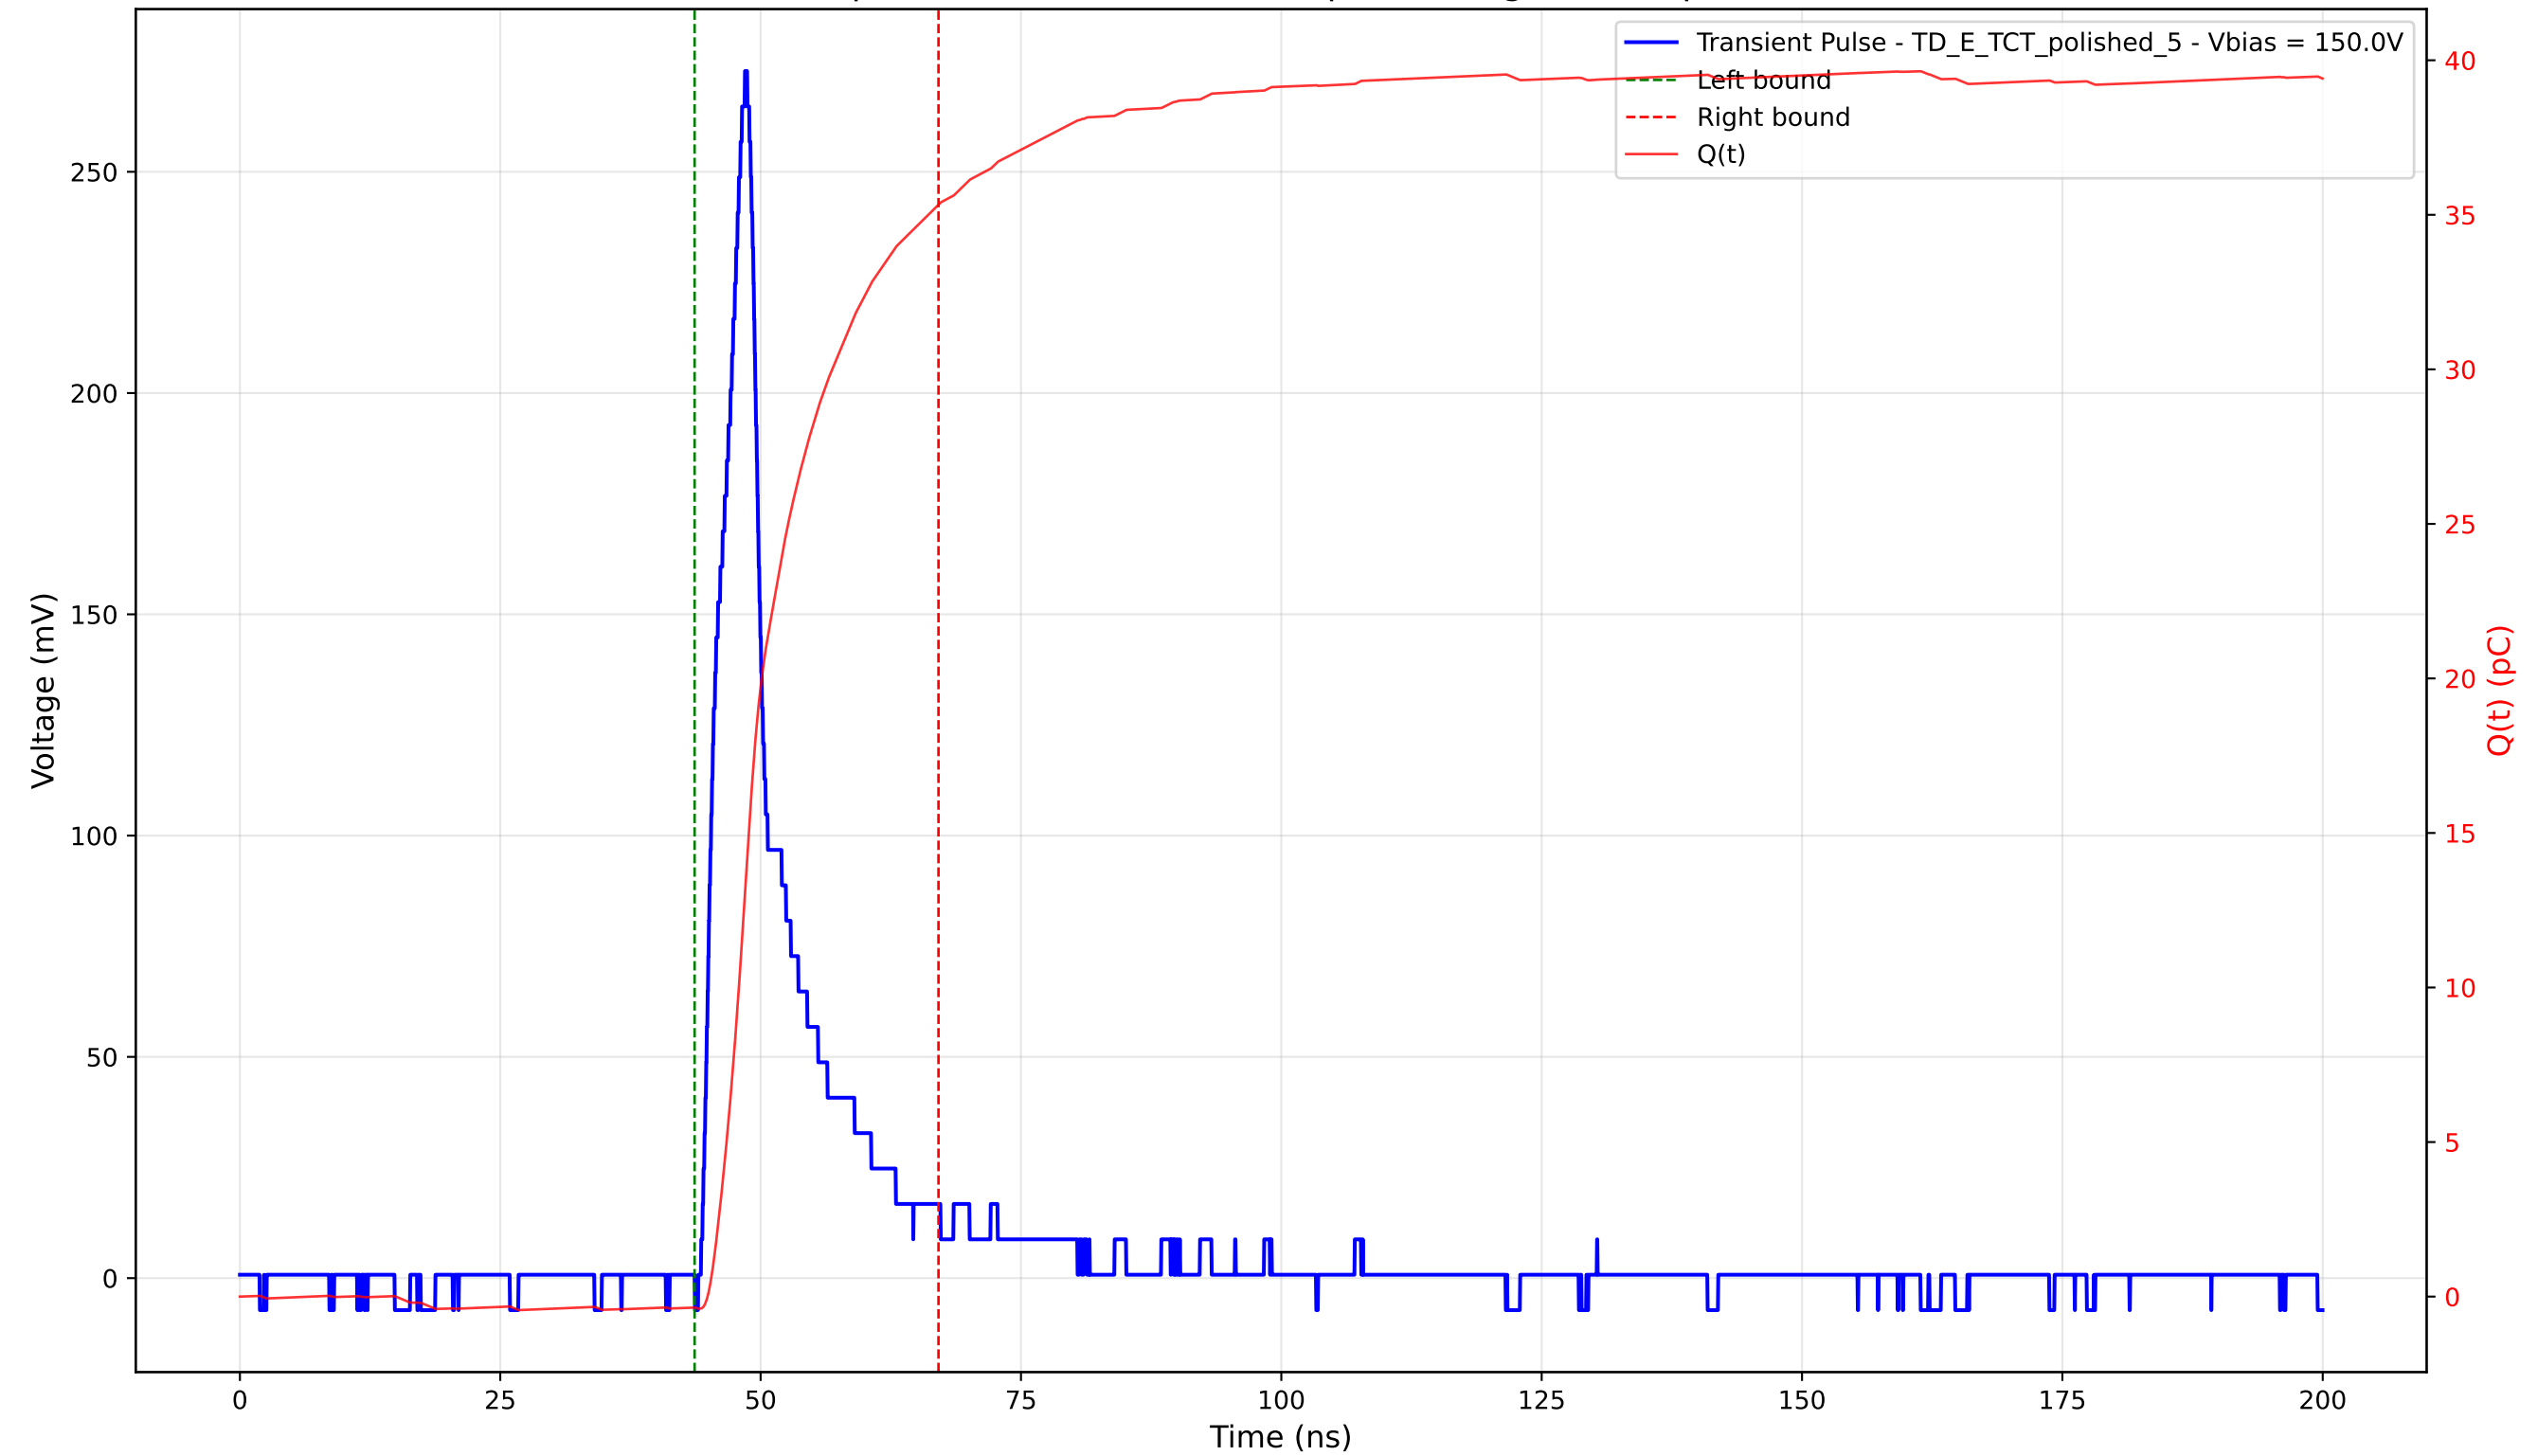


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 36.53 pC - Rise Time: 3.49 ns

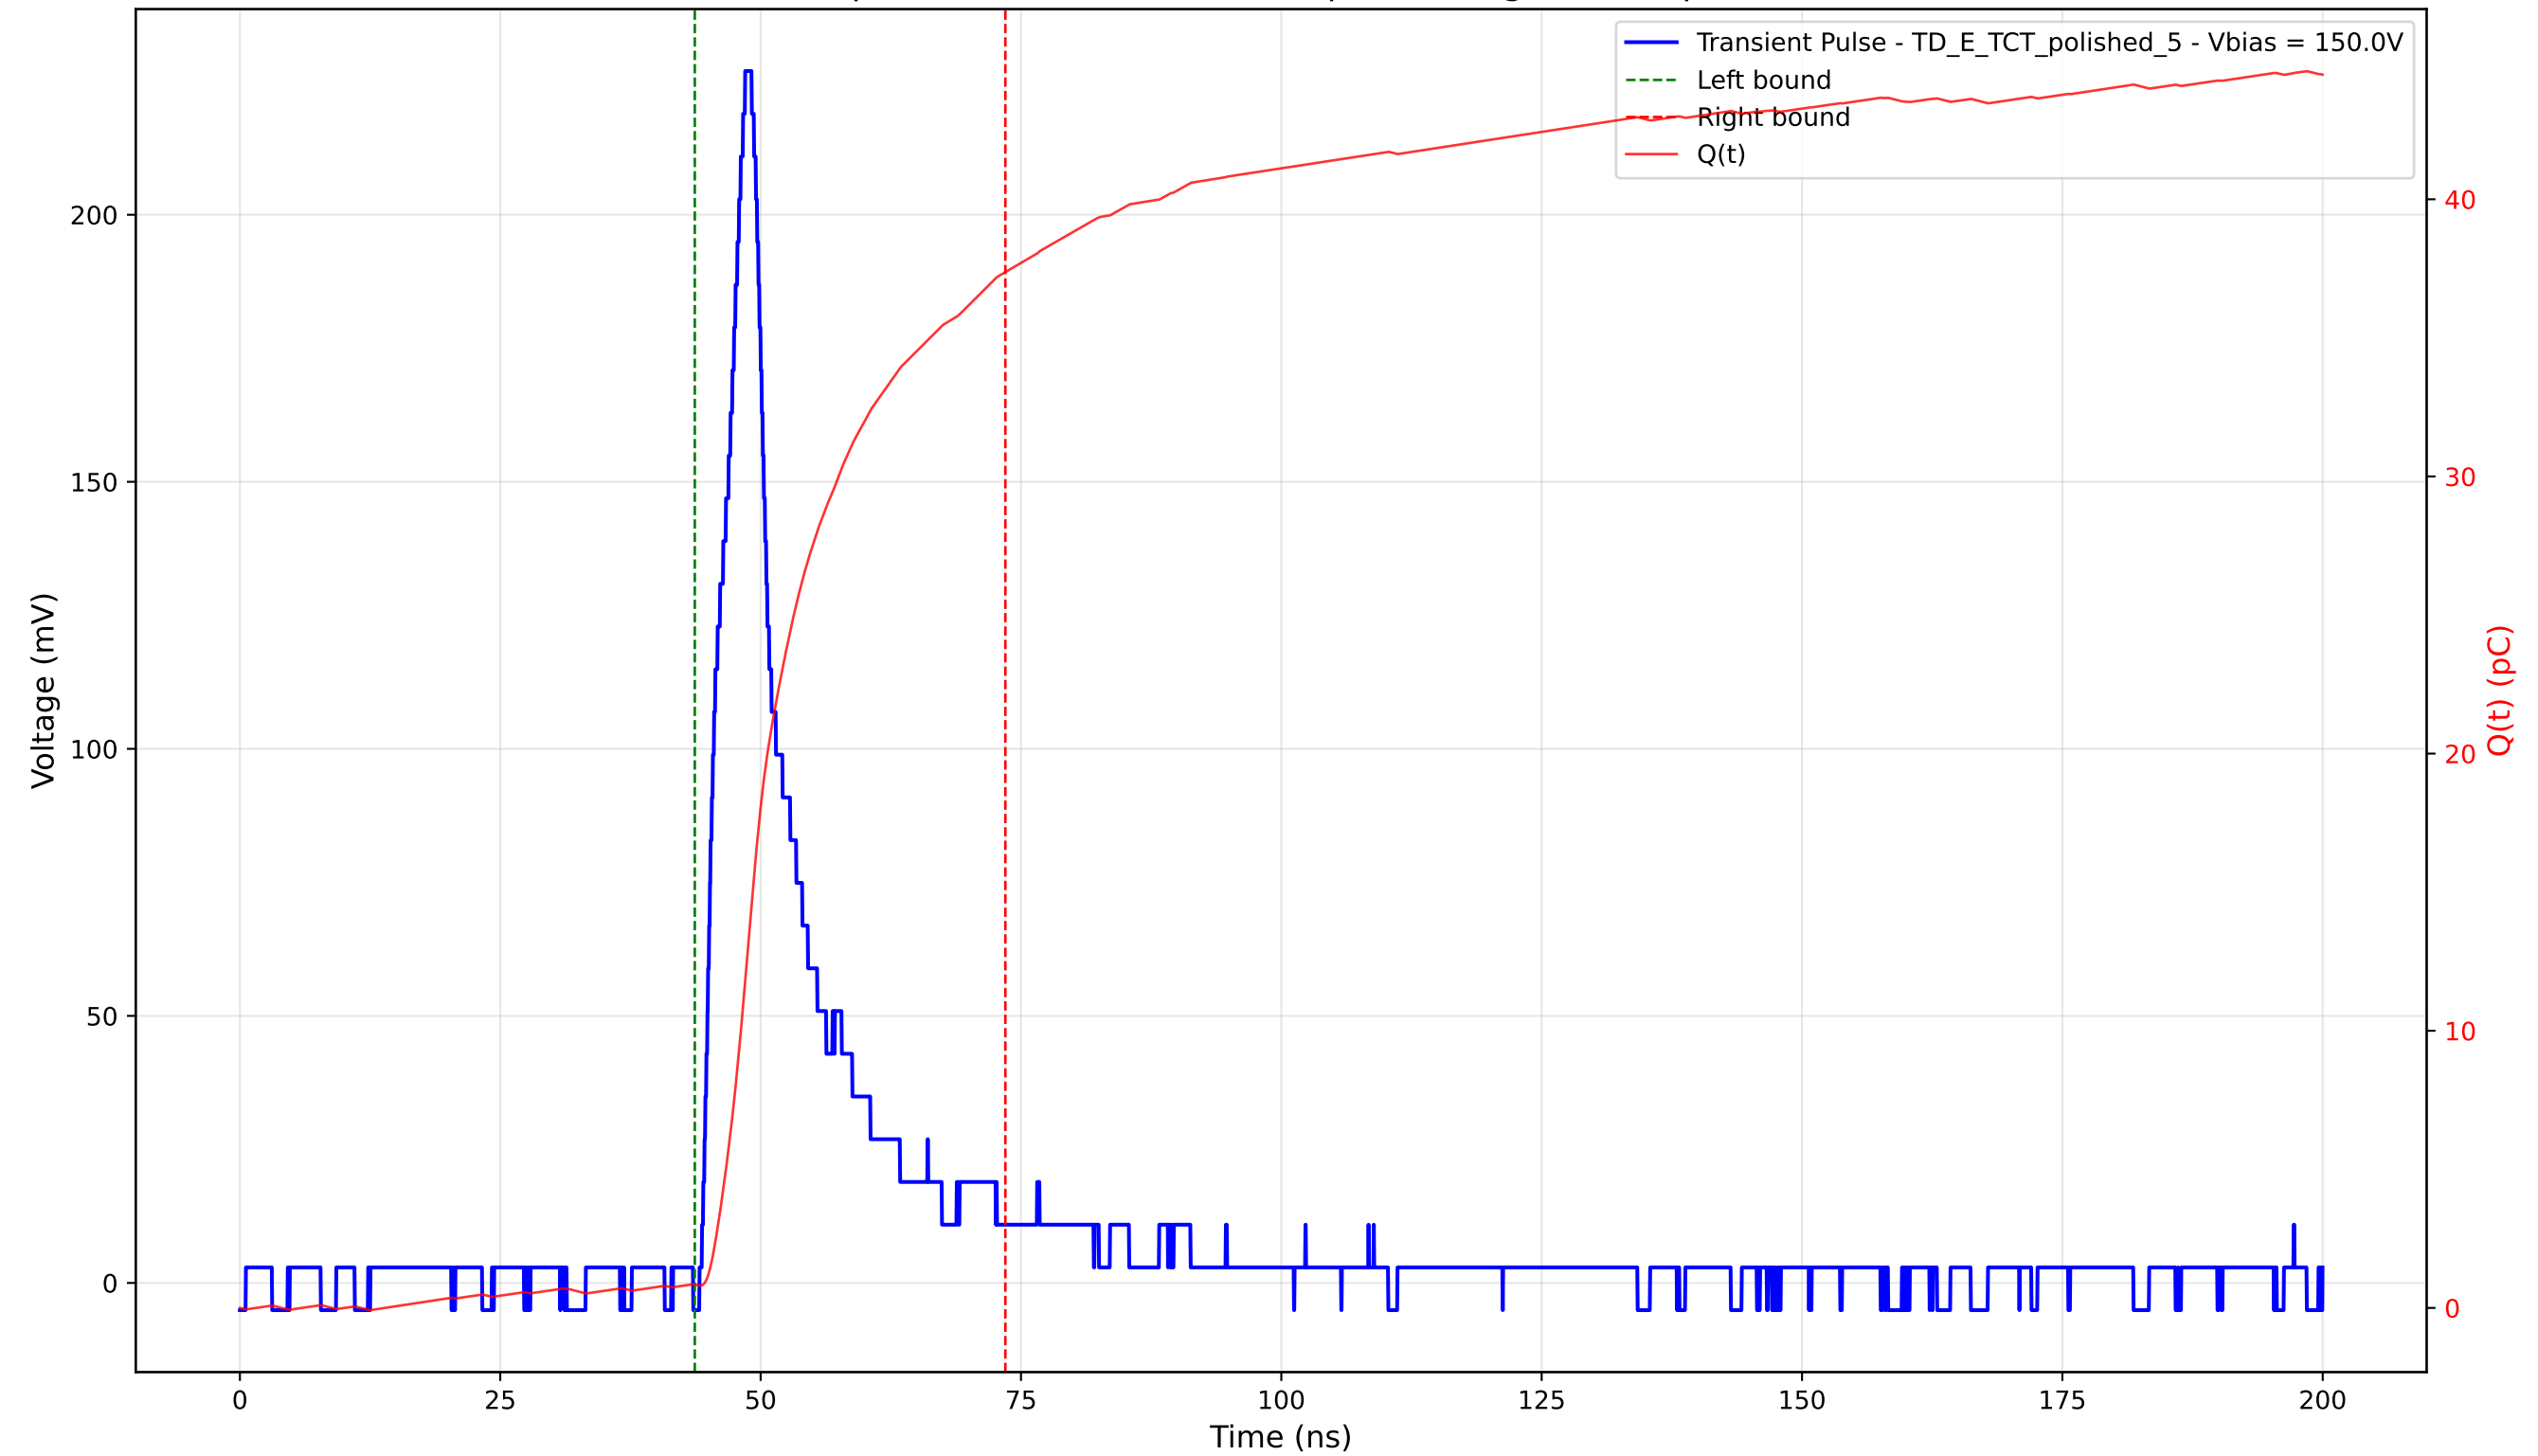


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 32.35 pC - Rise Time: 3.46 ns

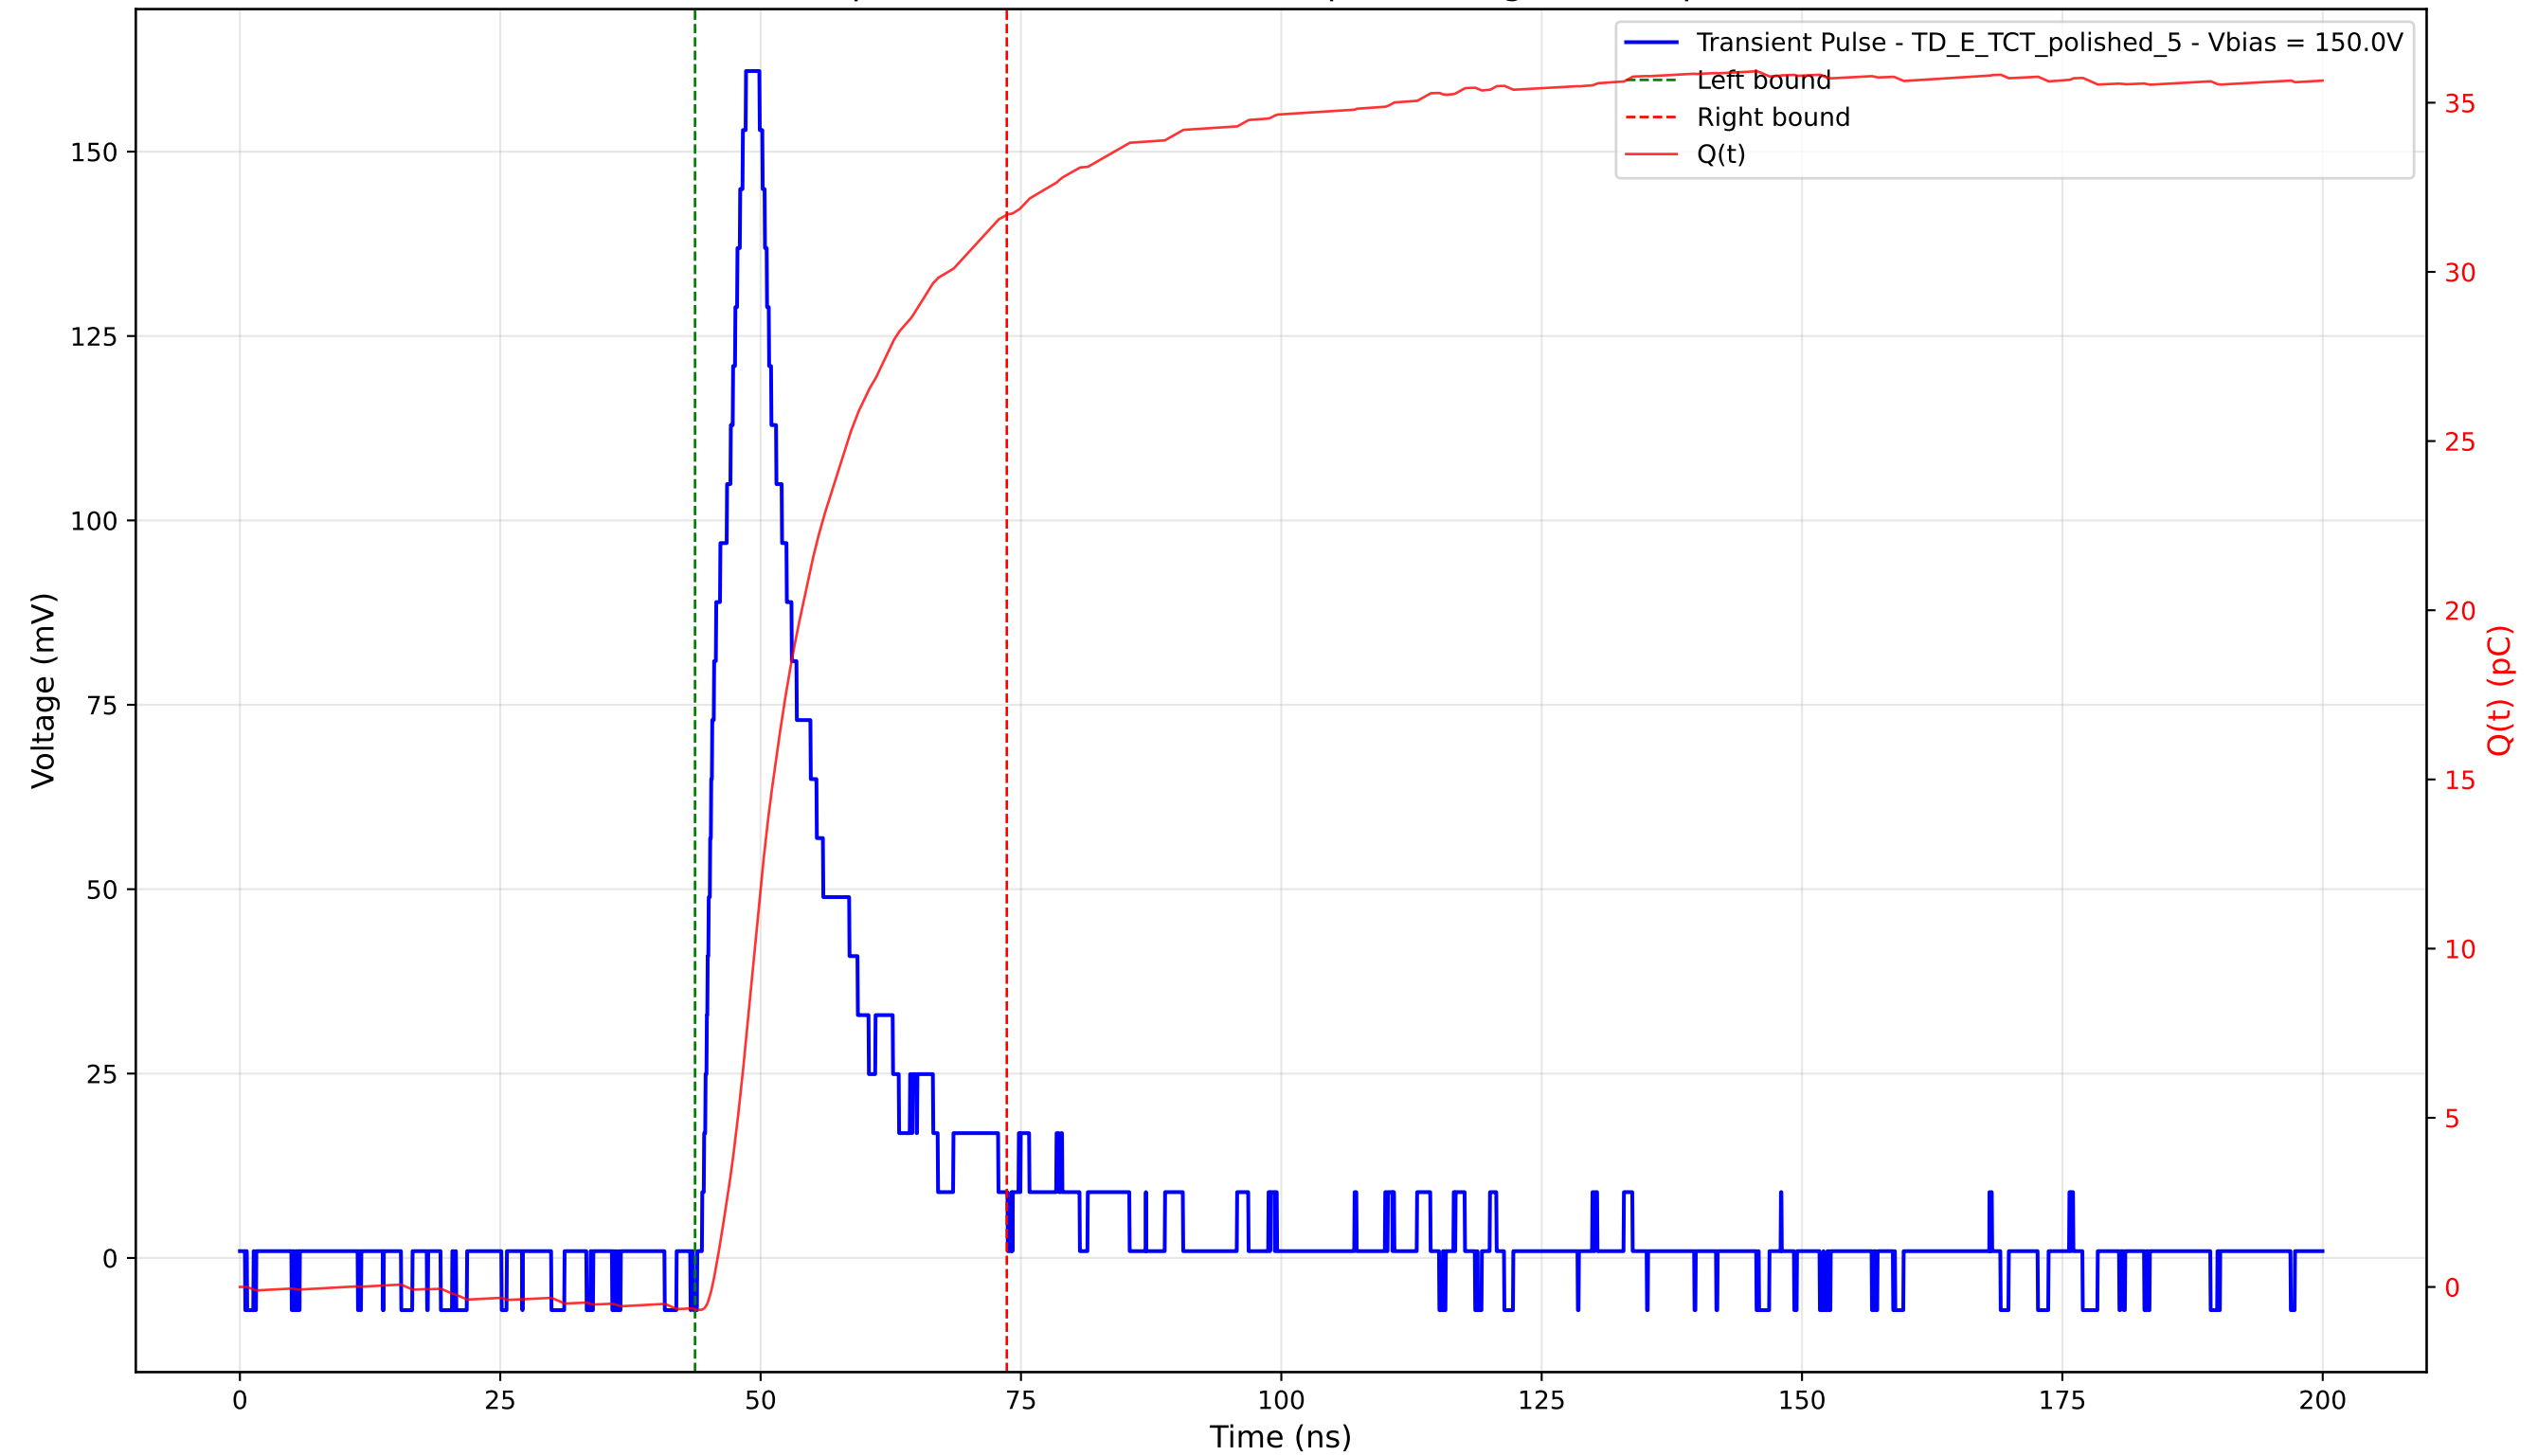


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 30.83 pC - Rise Time: 3.94 ns

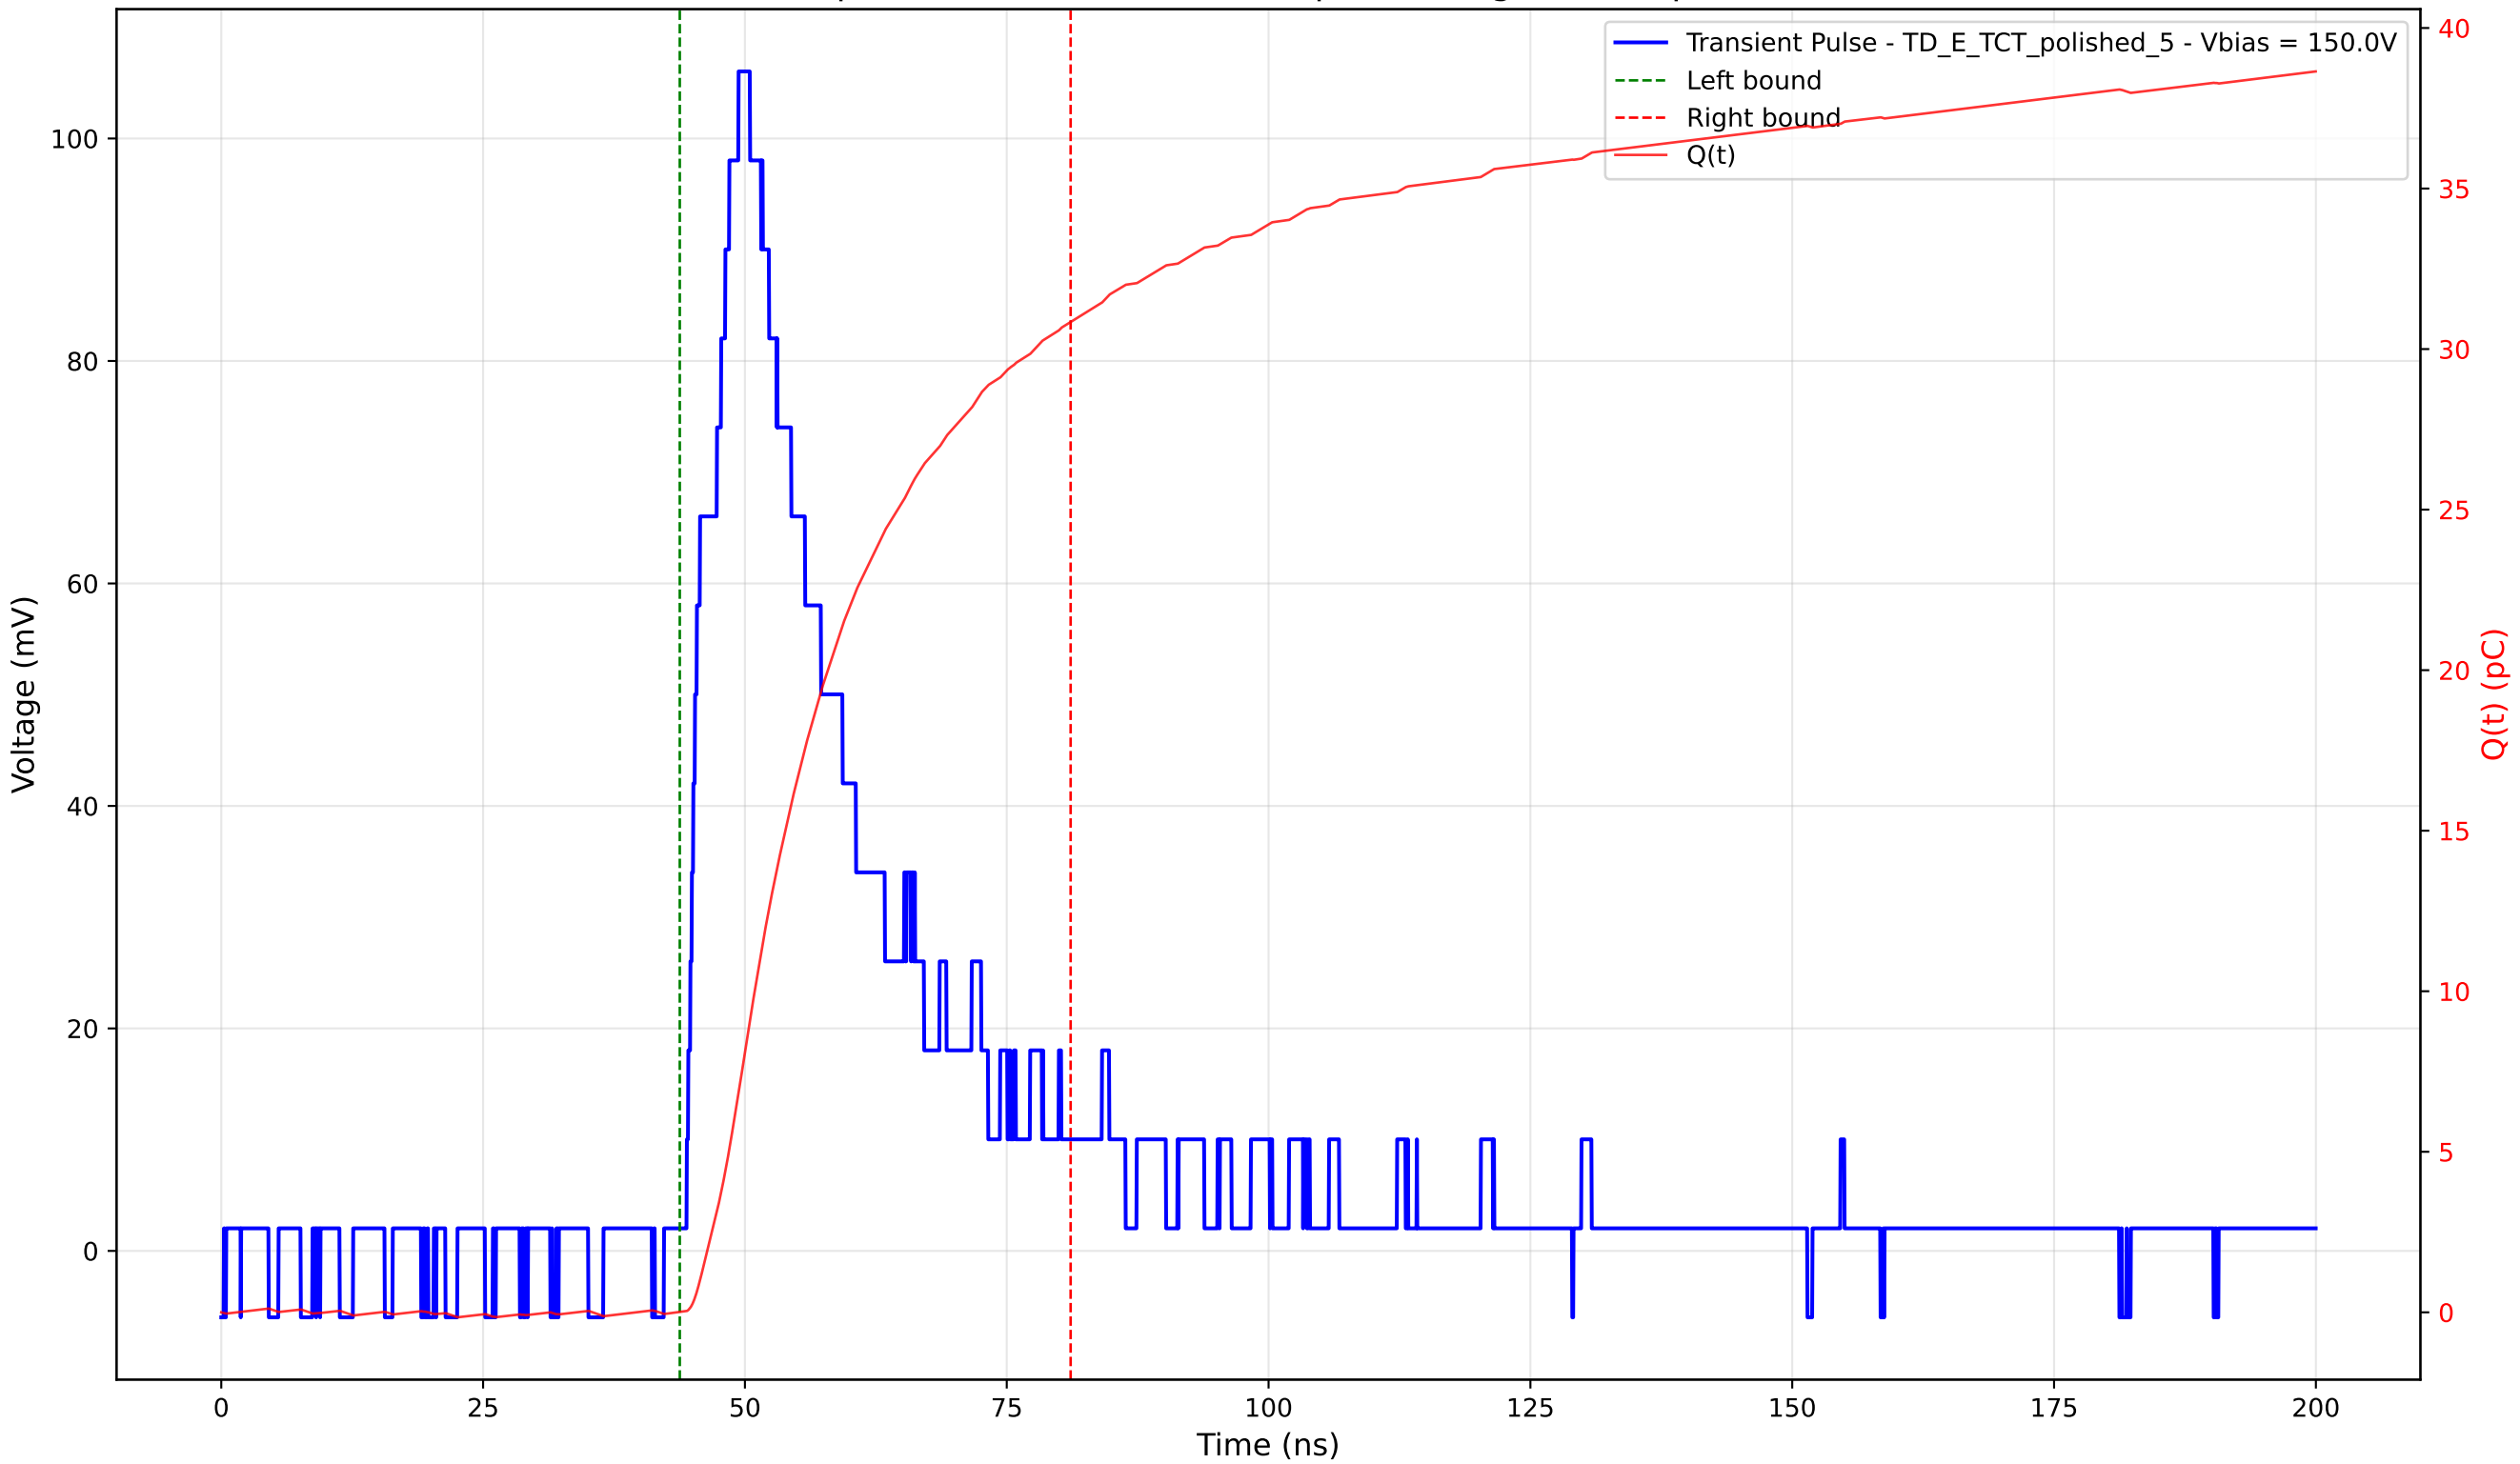


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 28.29 pC - Rise Time: 6.77 ns

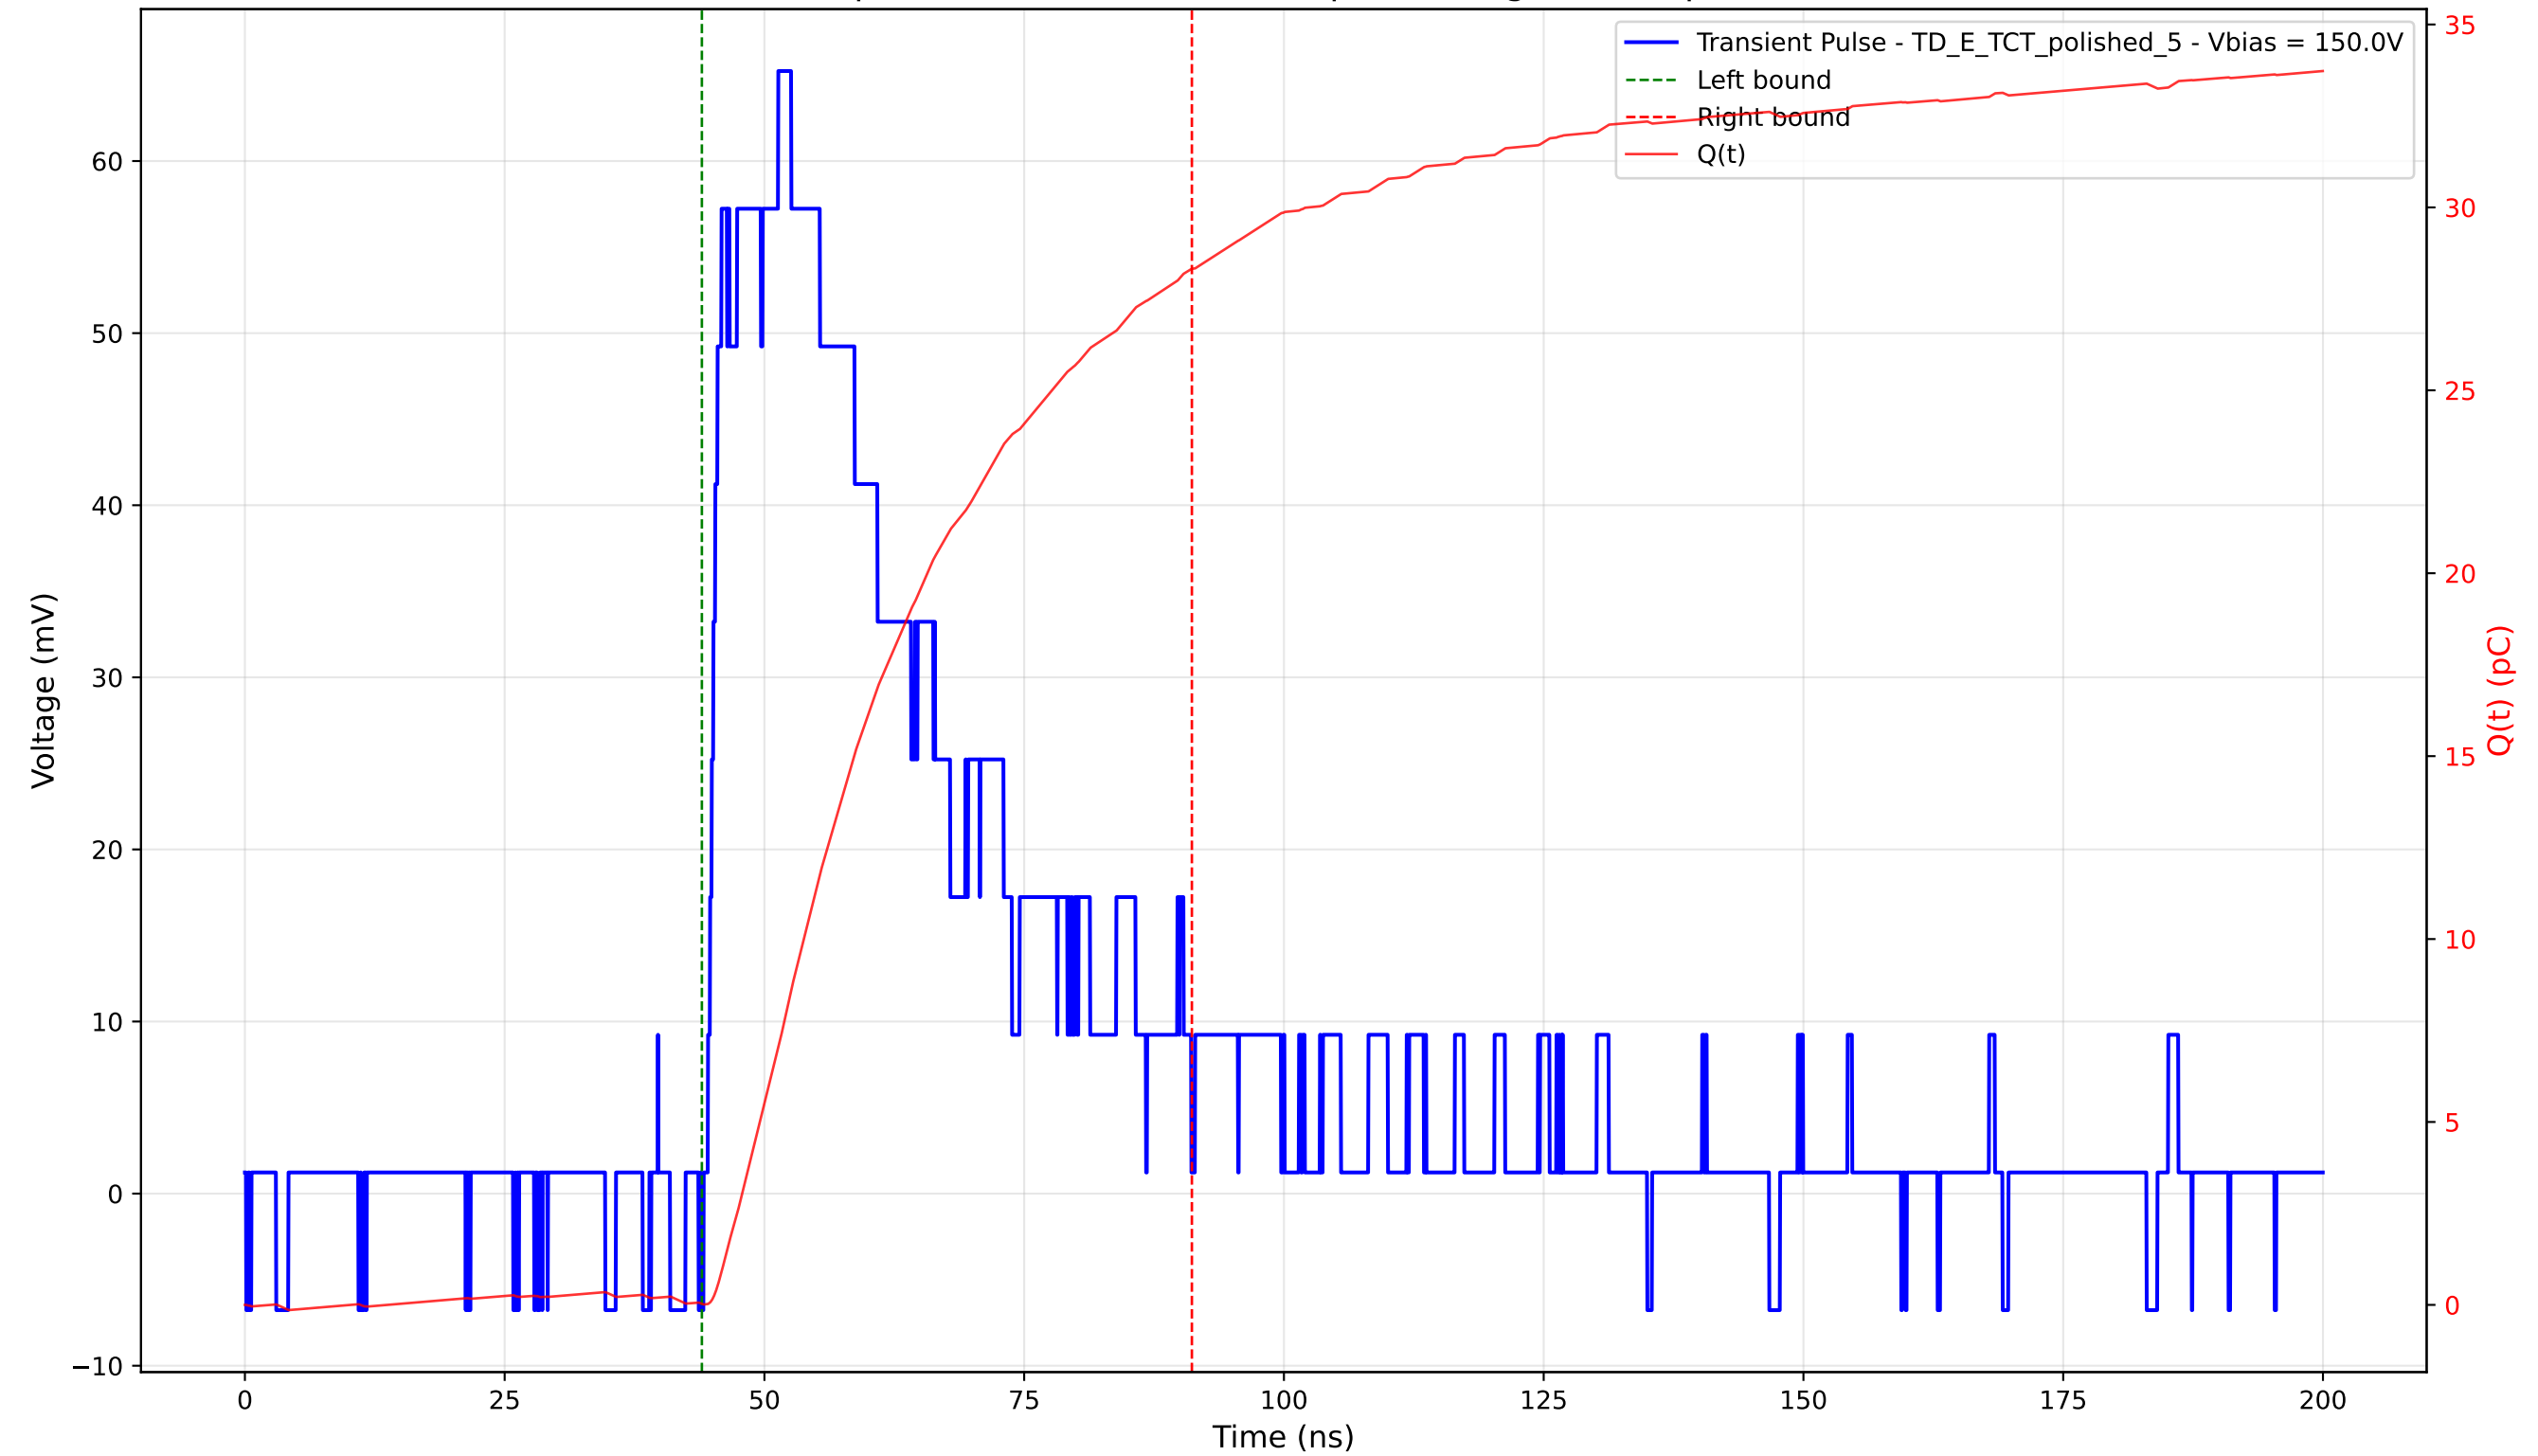


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 22.47 pC - Rise Time: 1.01 ns

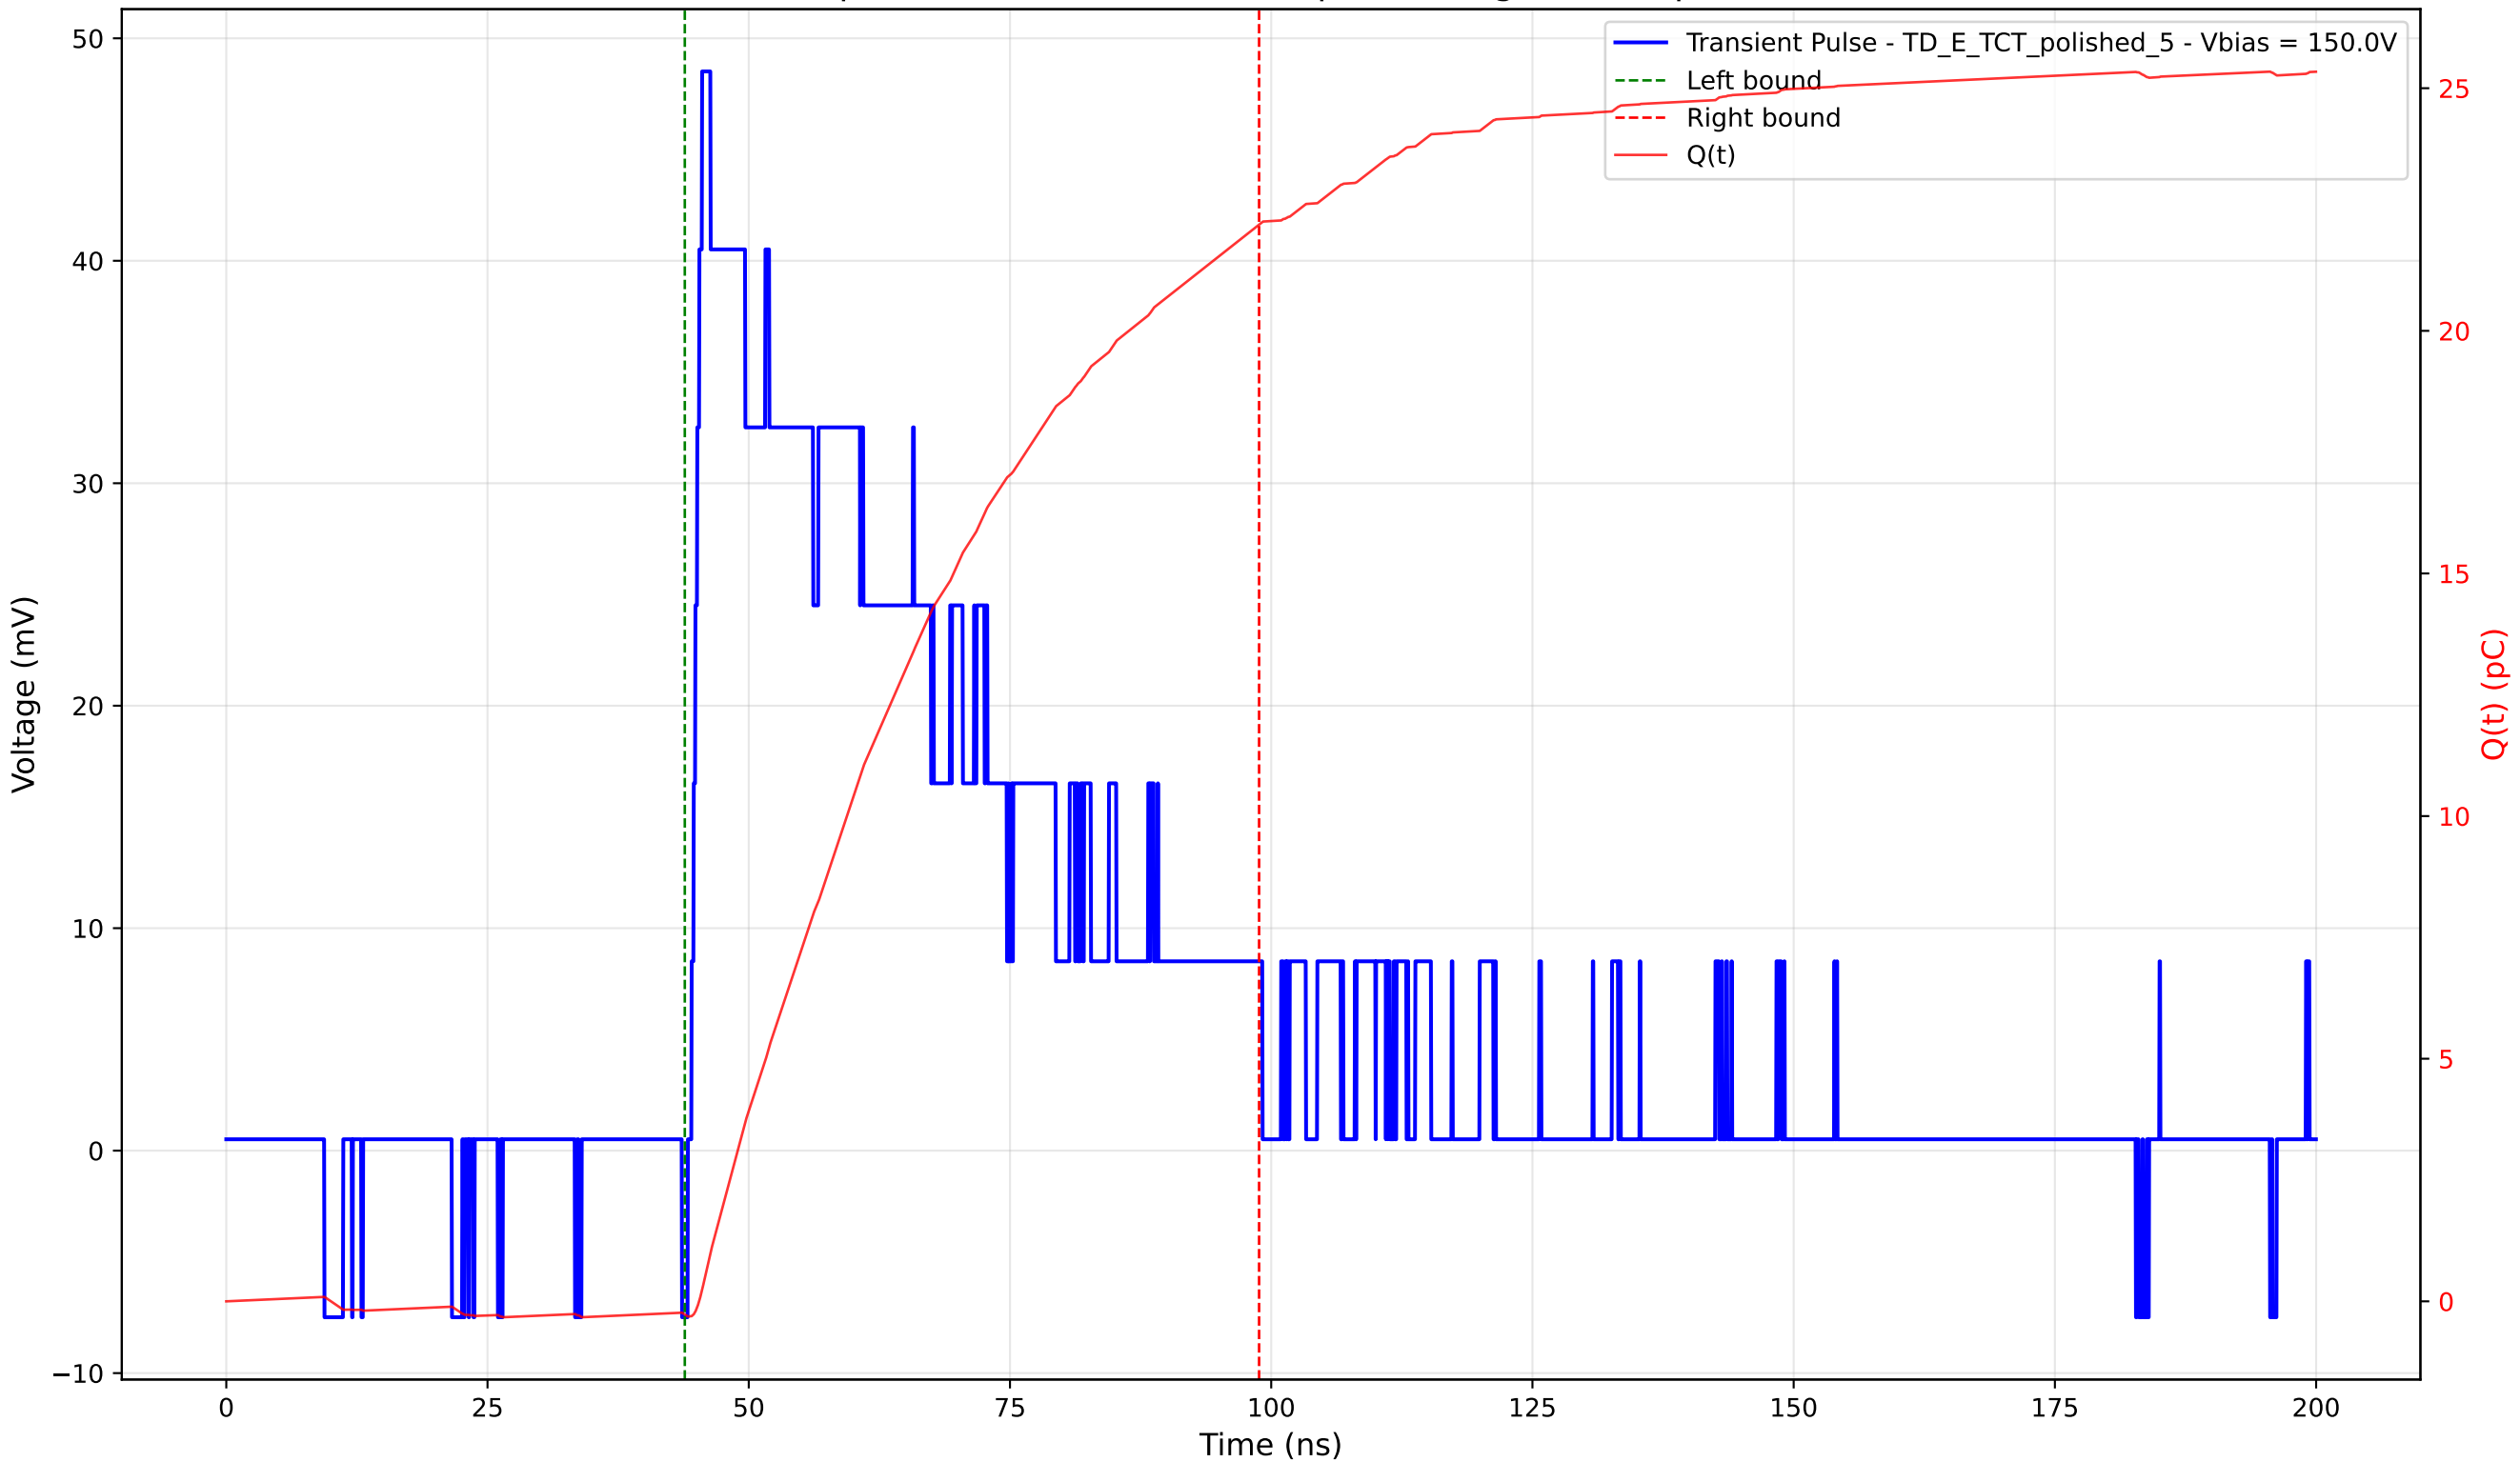


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 16.58 pC - Rise Time: 1.13 ns

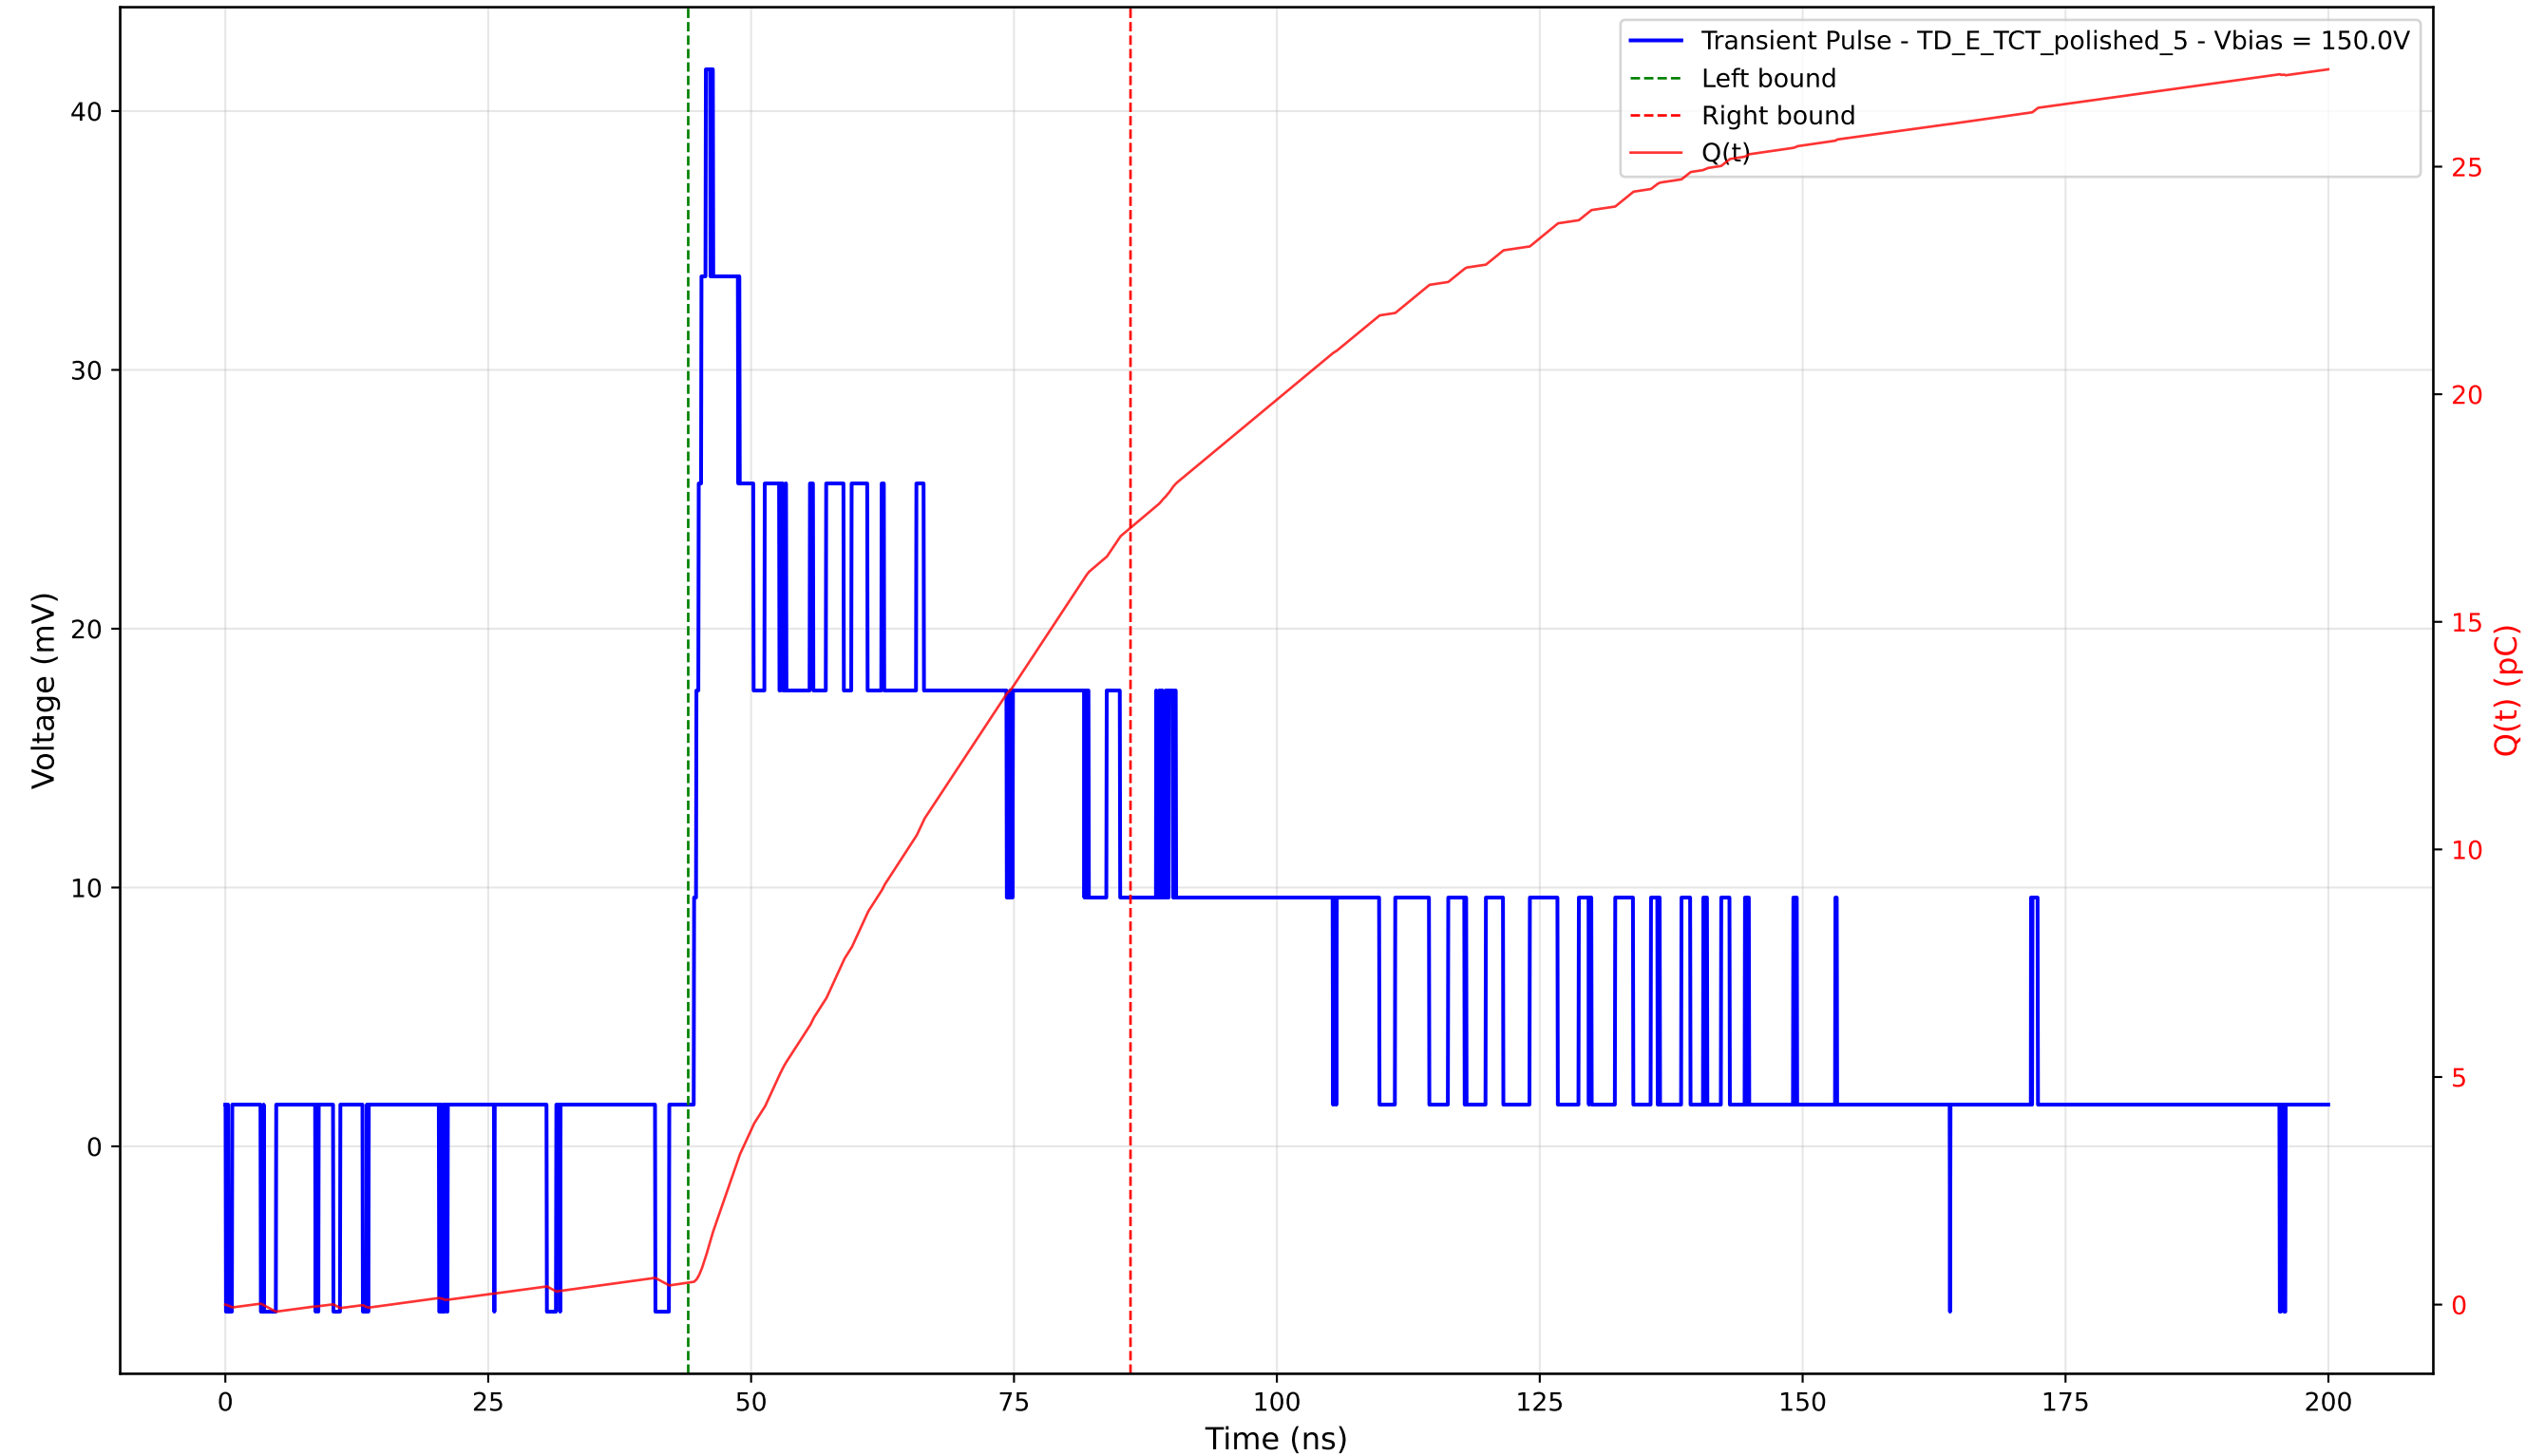


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 13.08 pC - Rise Time: 0.84 ns

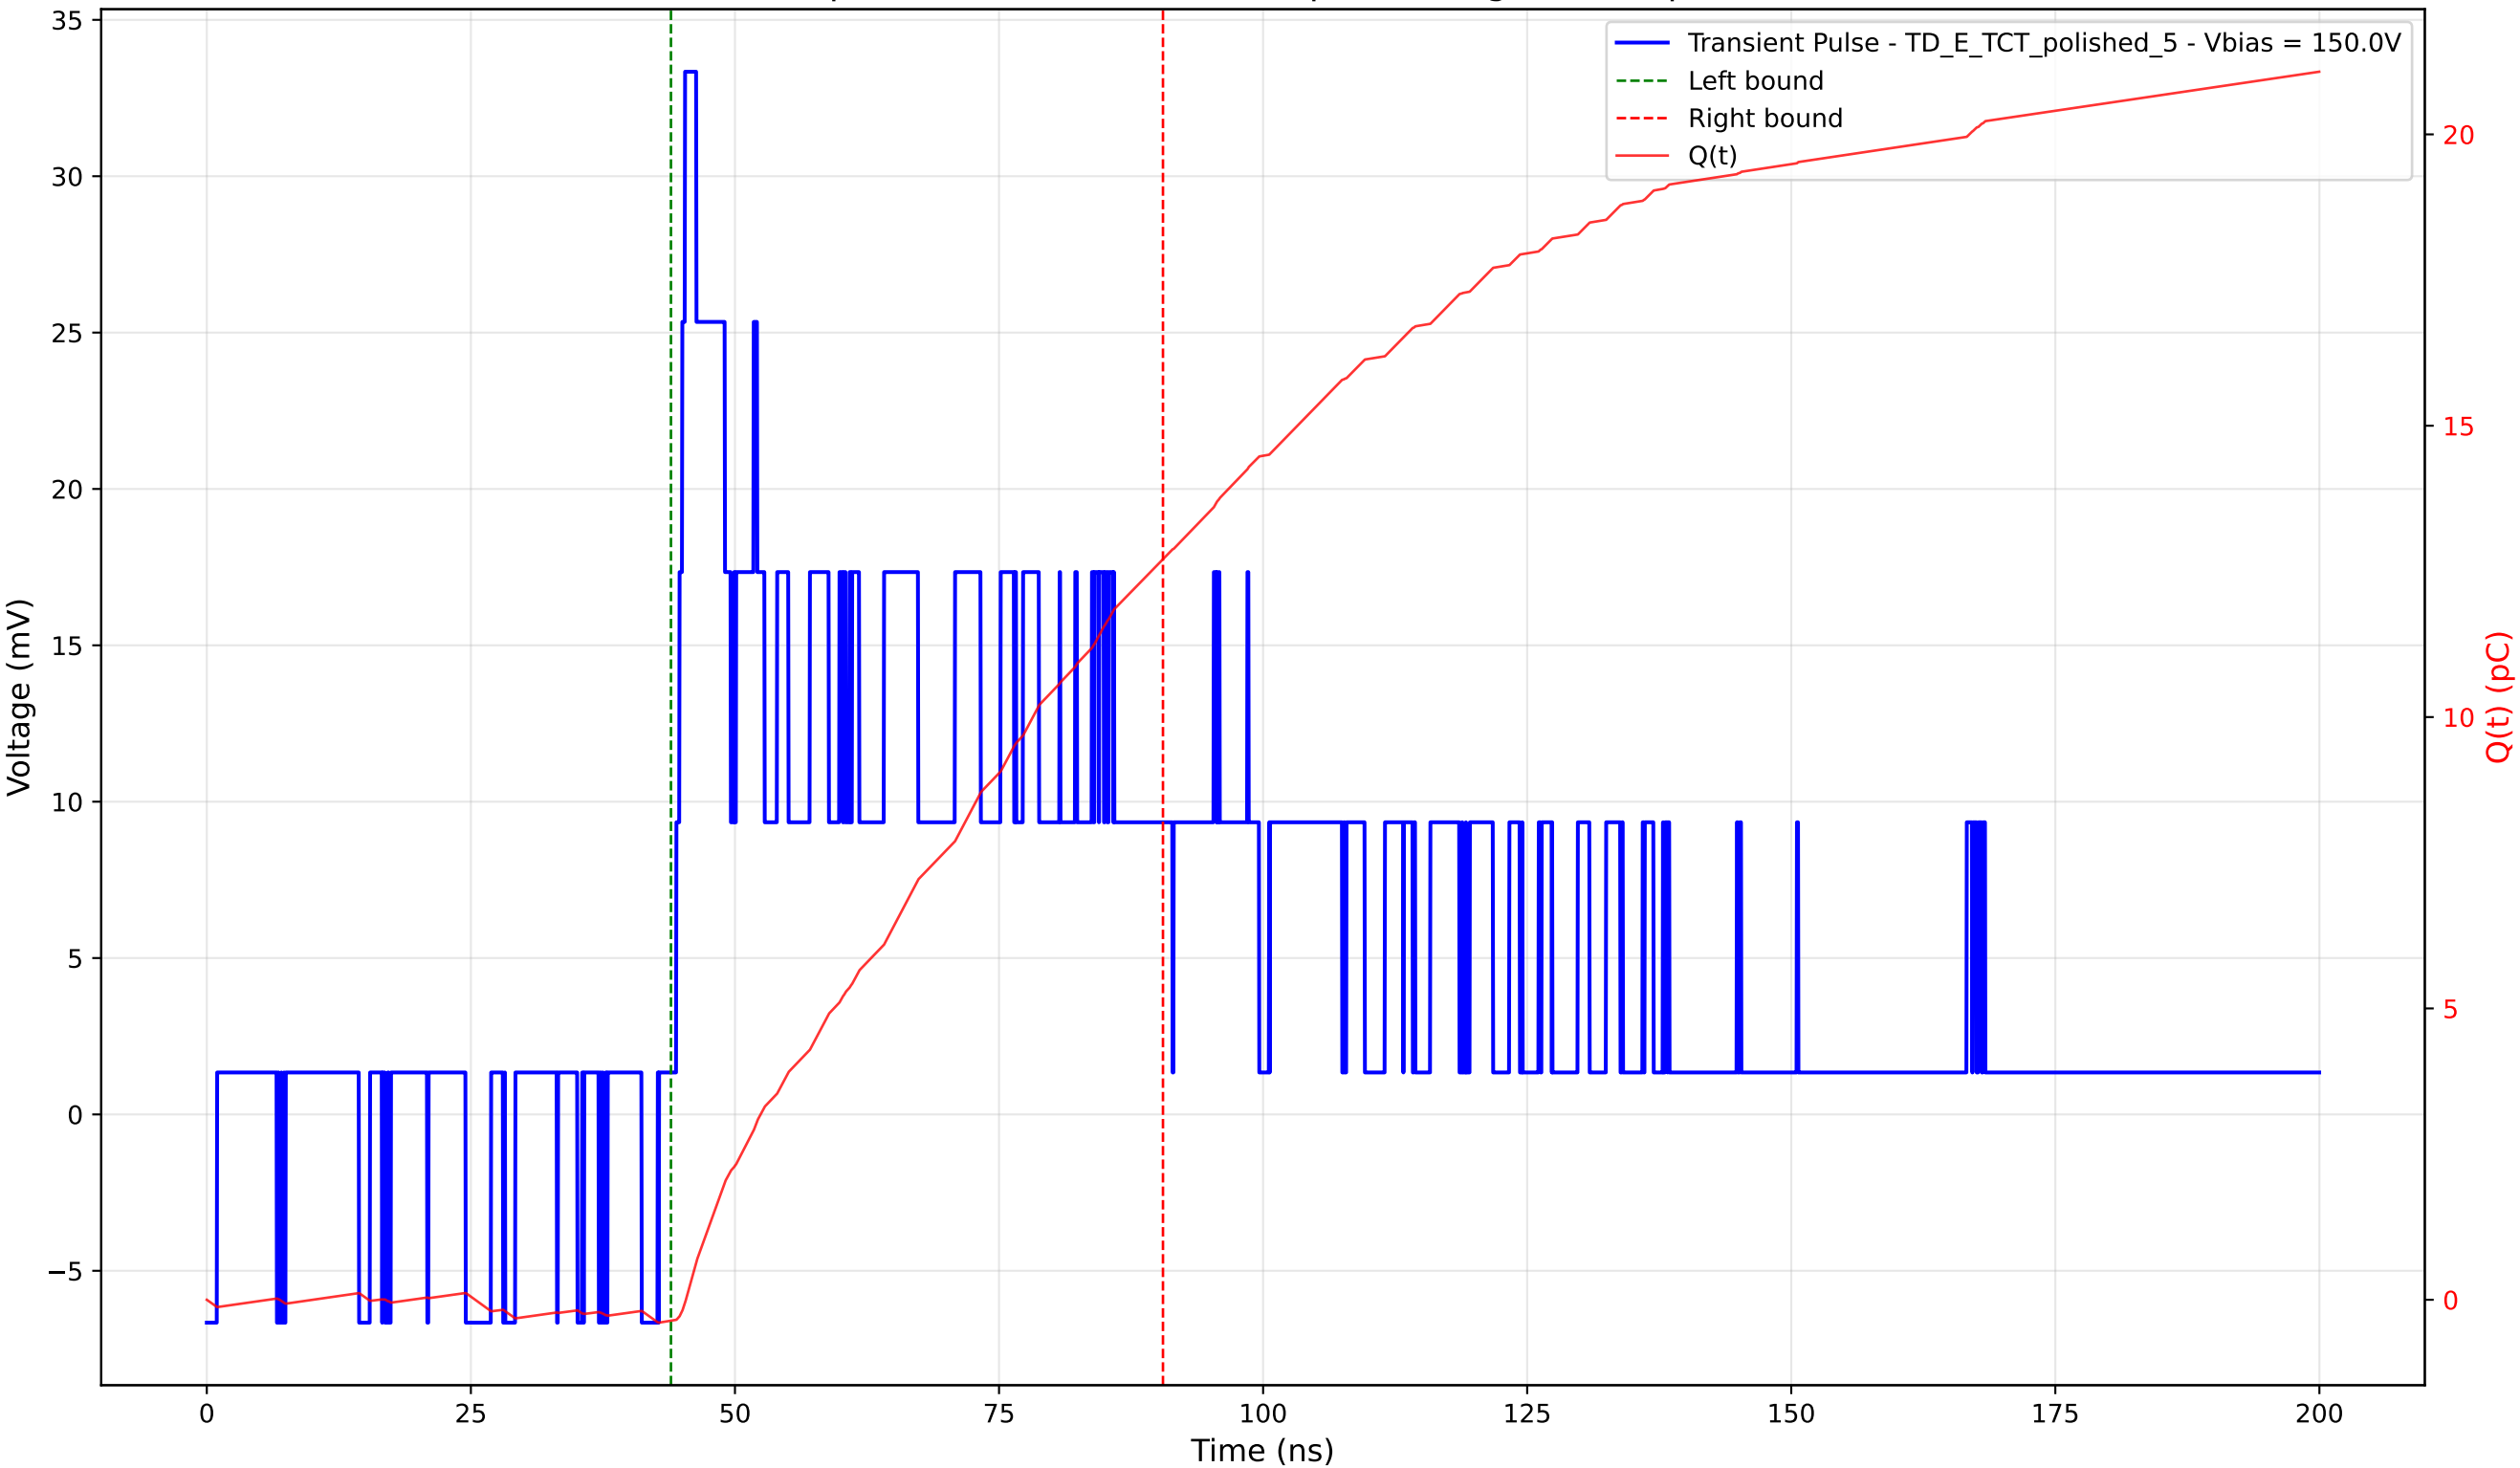


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 3.85 pC - Rise Time: 0.70 ns

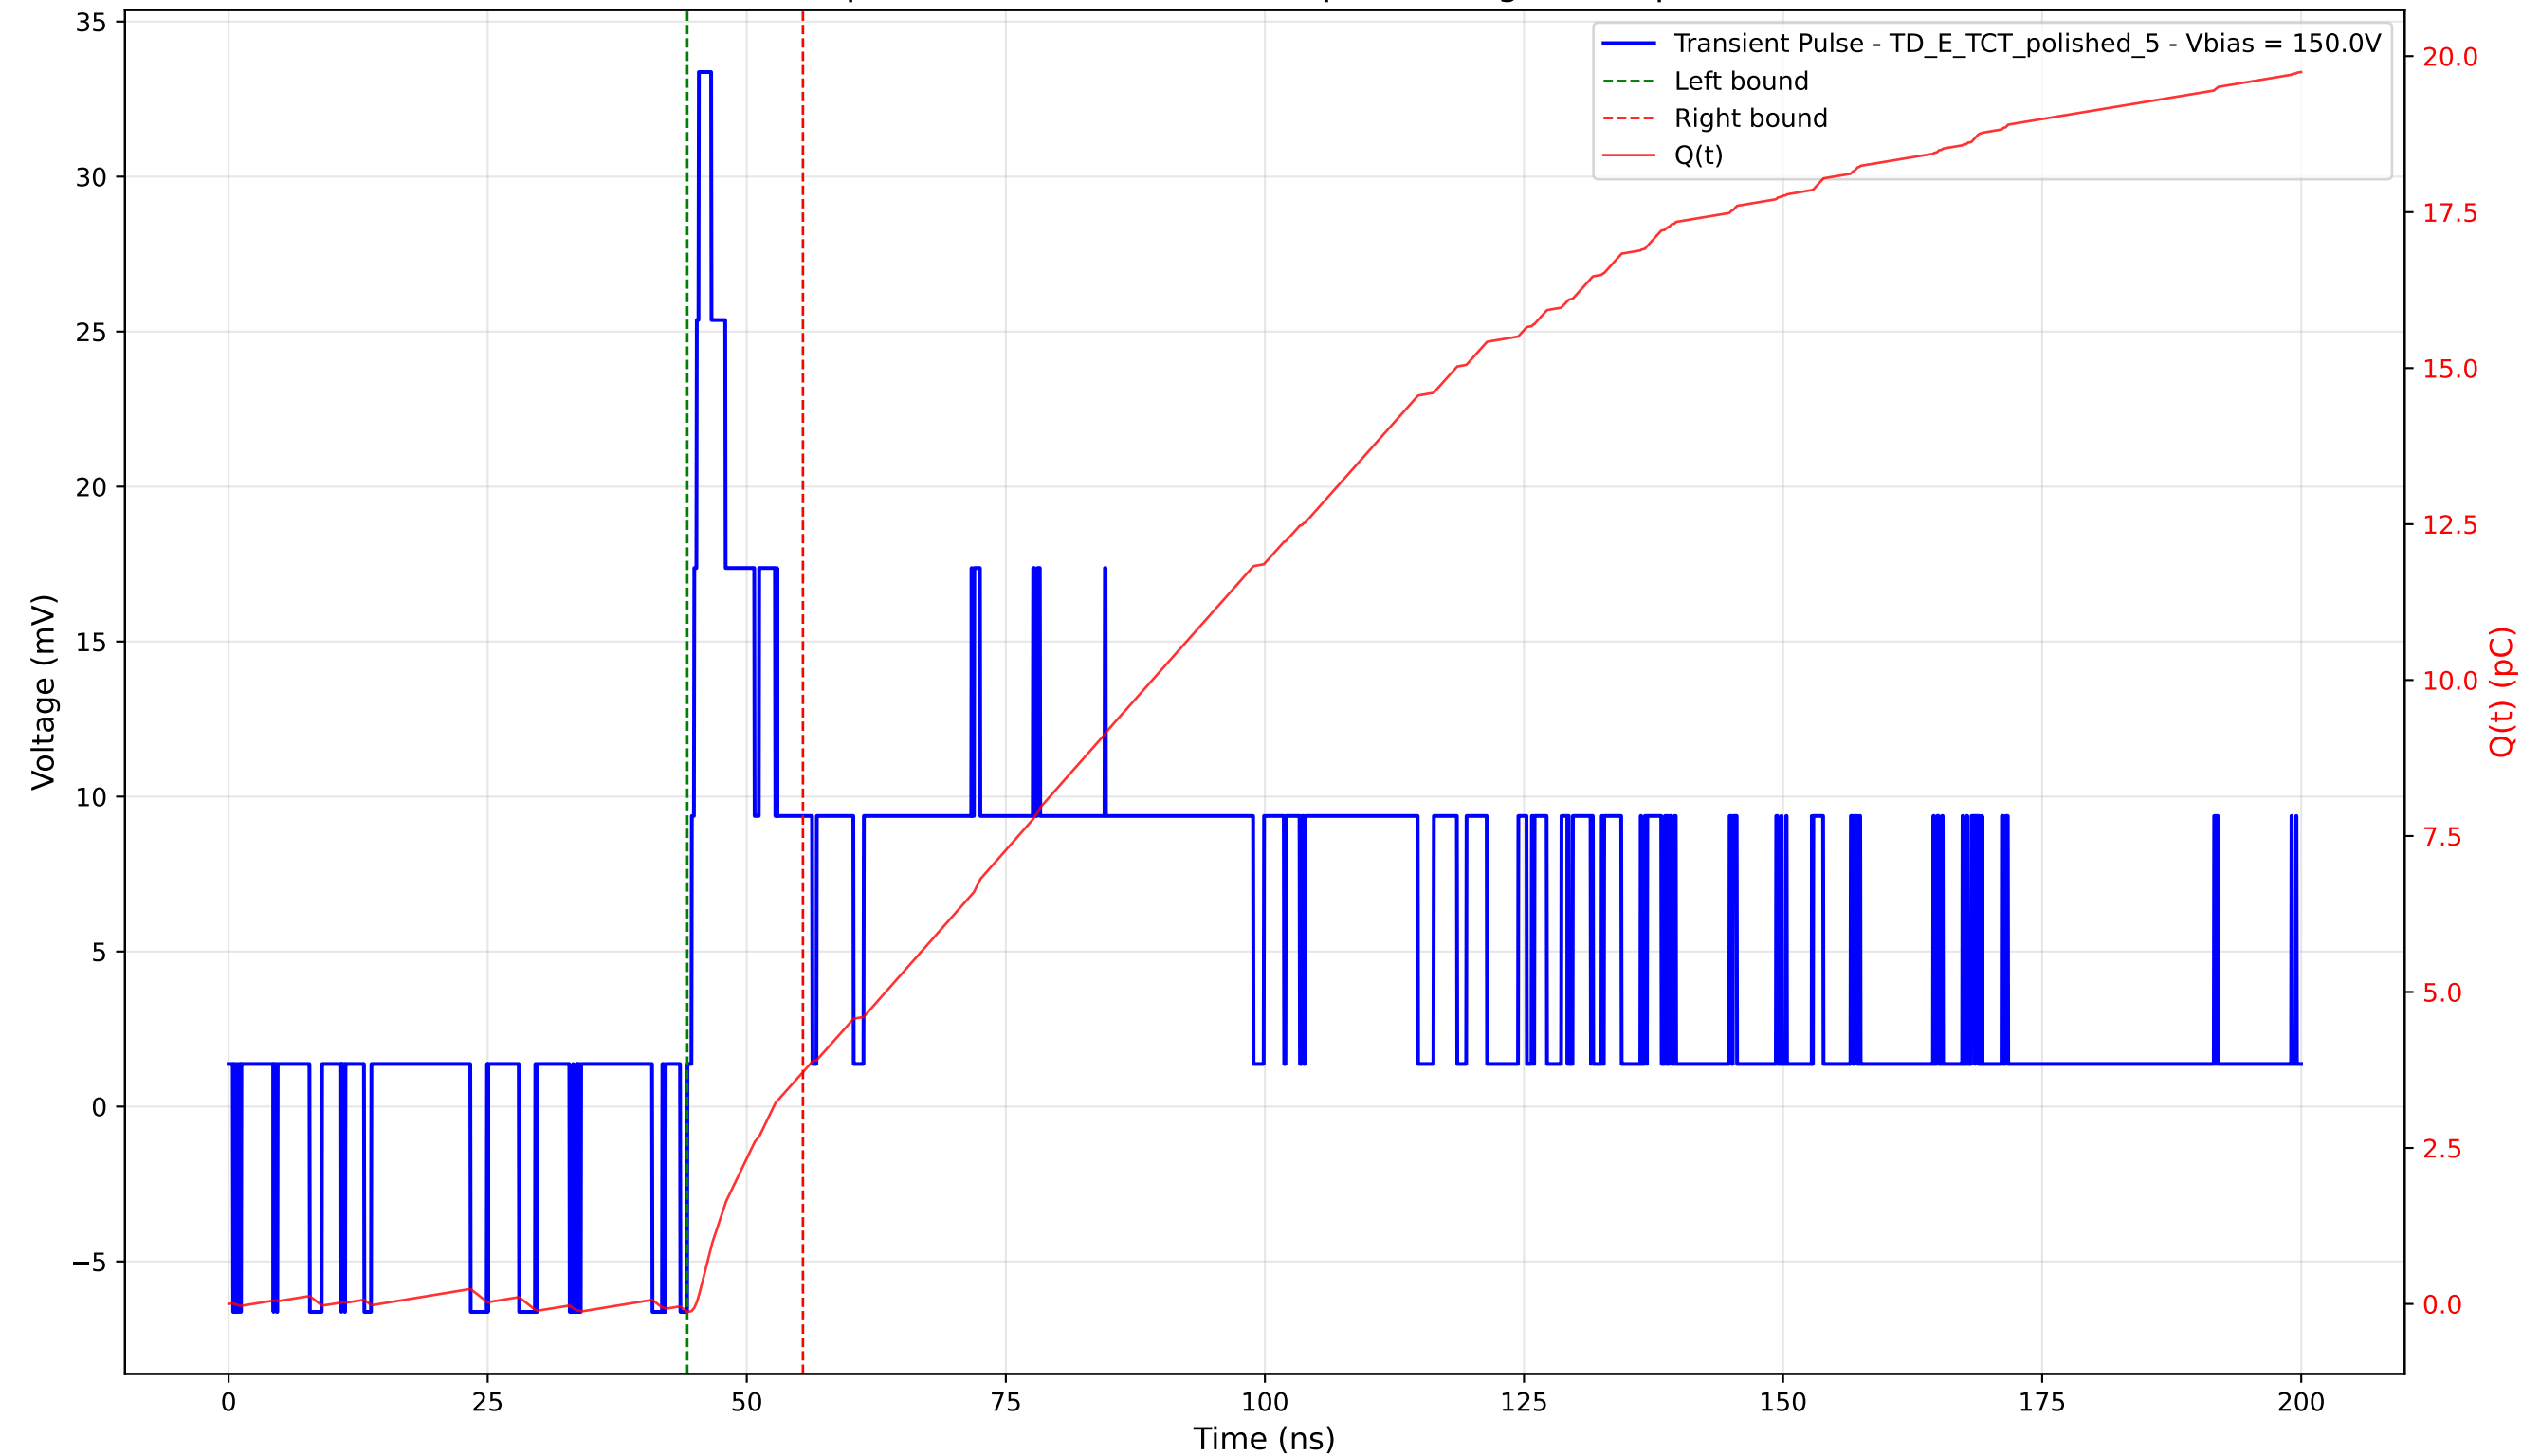


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 3.06 pC - Rise Time: 0.80 ns

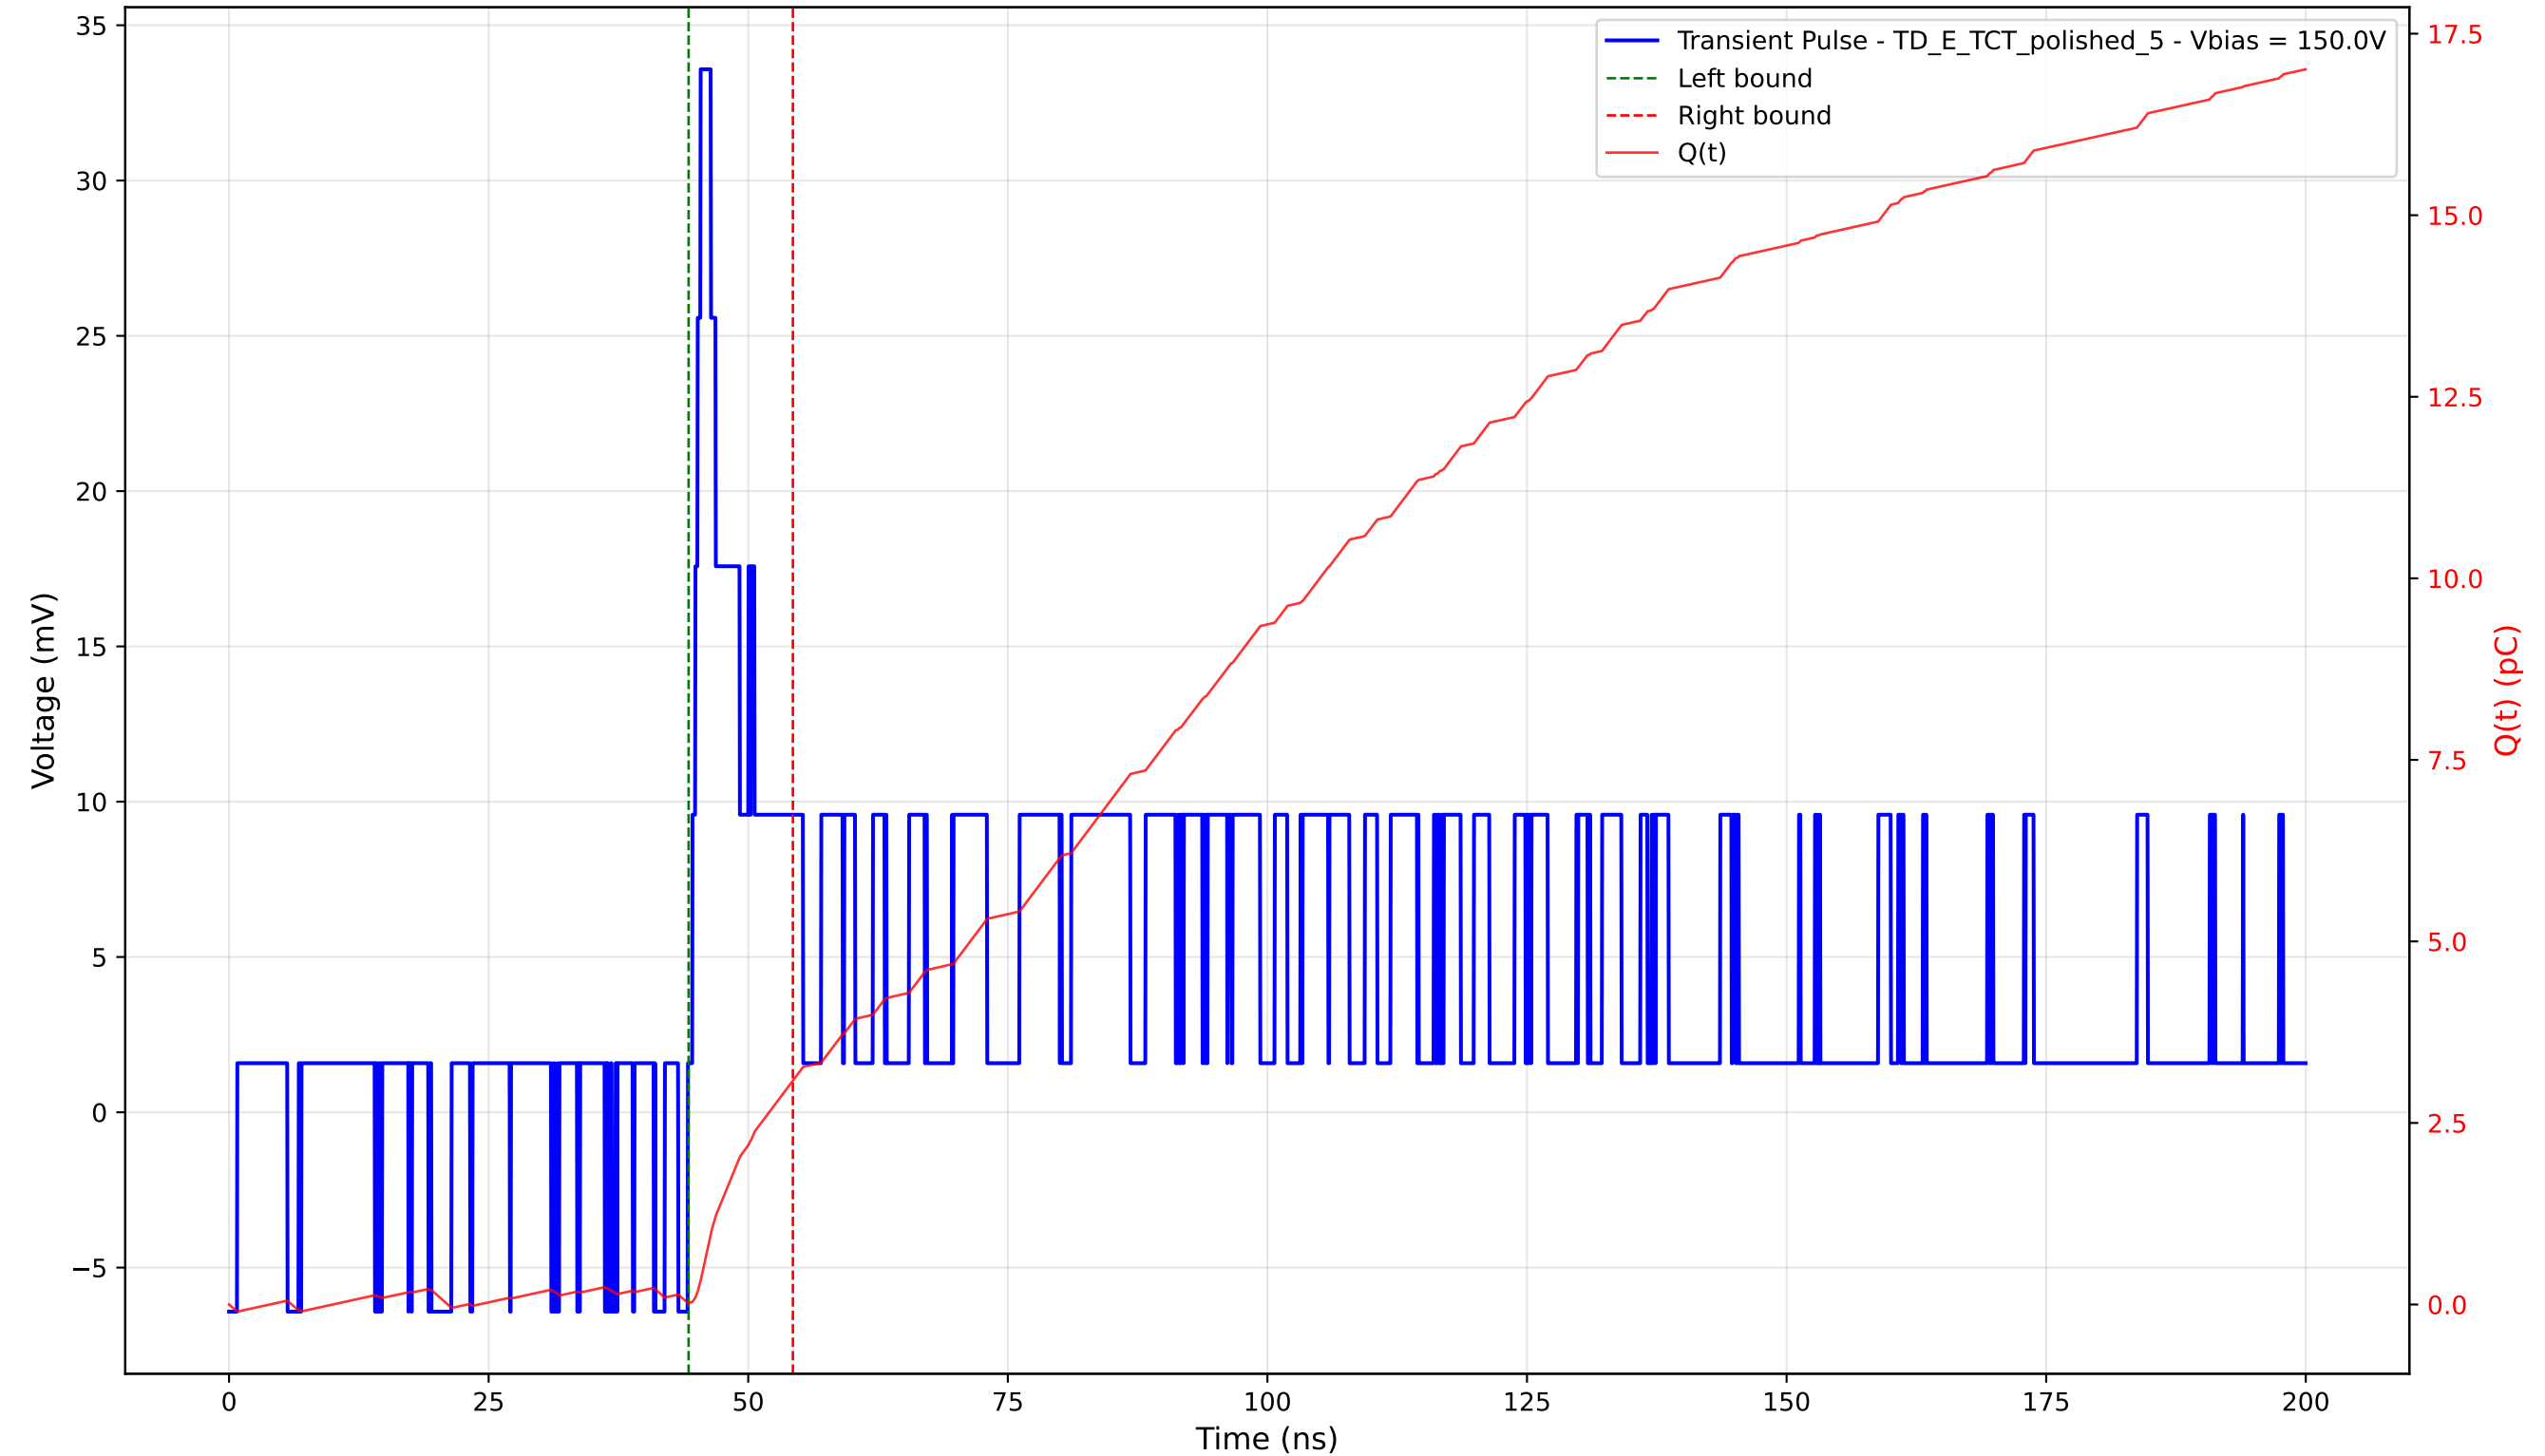


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 3.12 pC - Rise Time: 0.77 ns

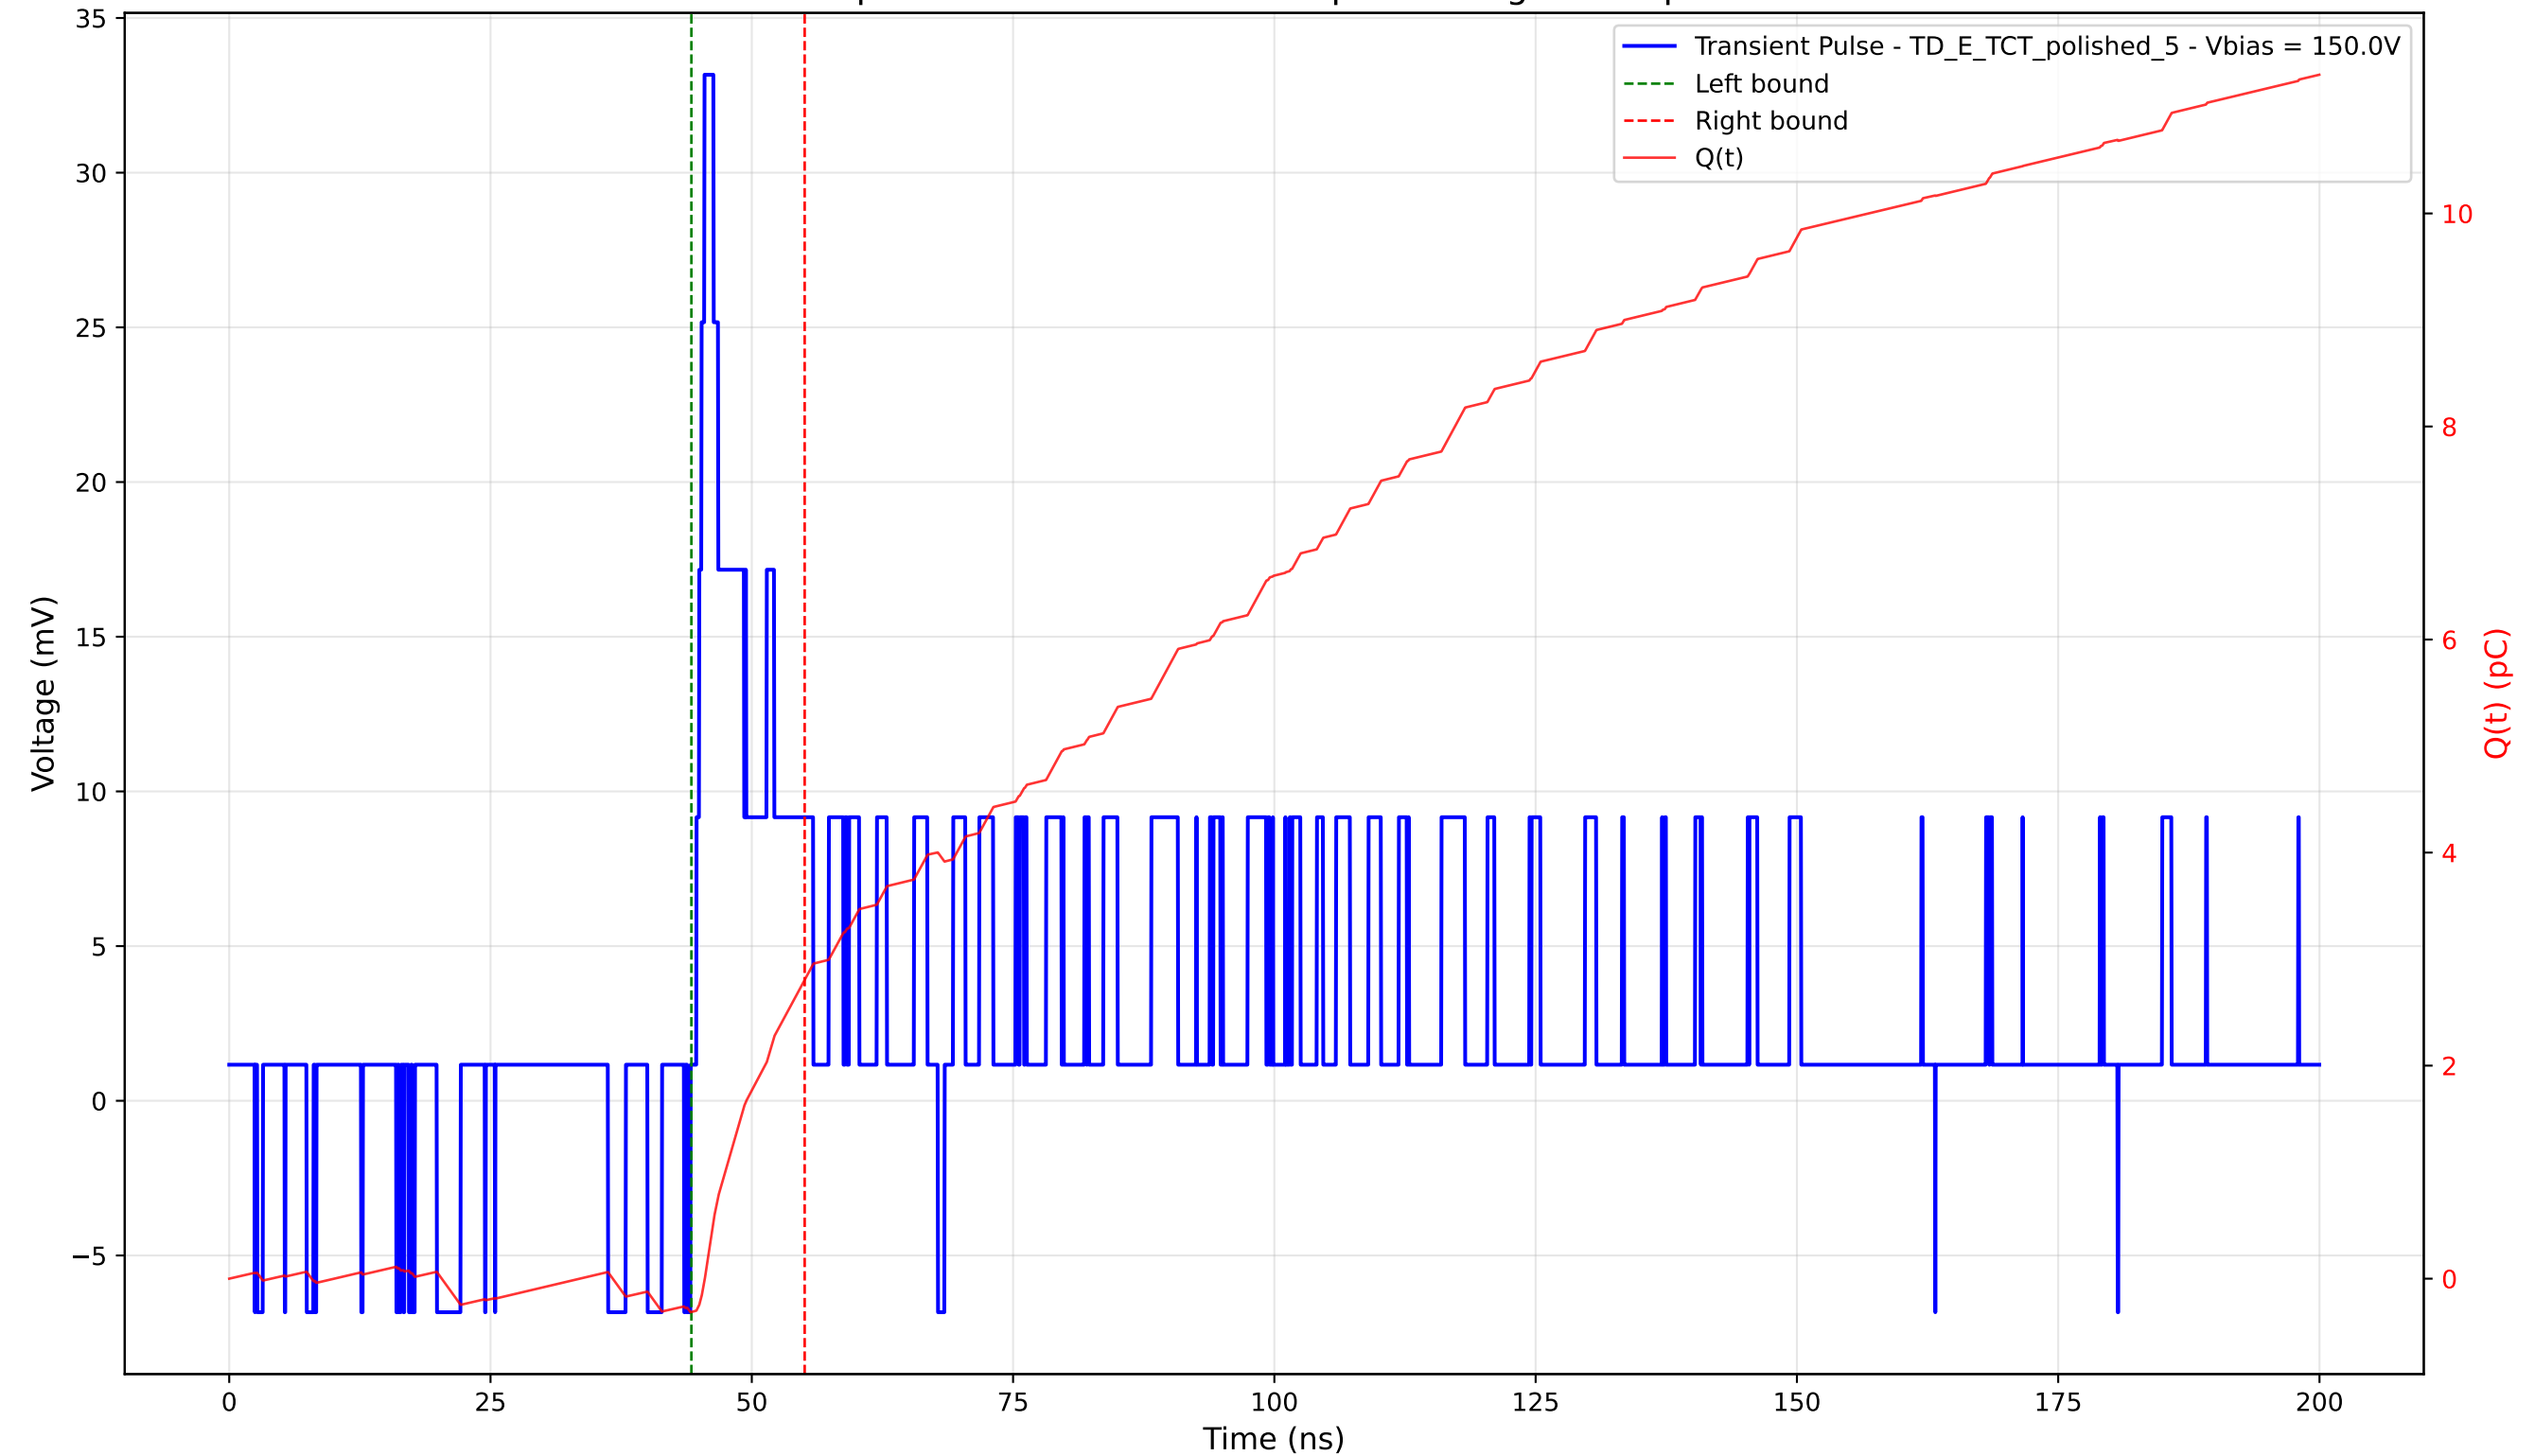


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 2.38 pC - Rise Time: 0.88 ns

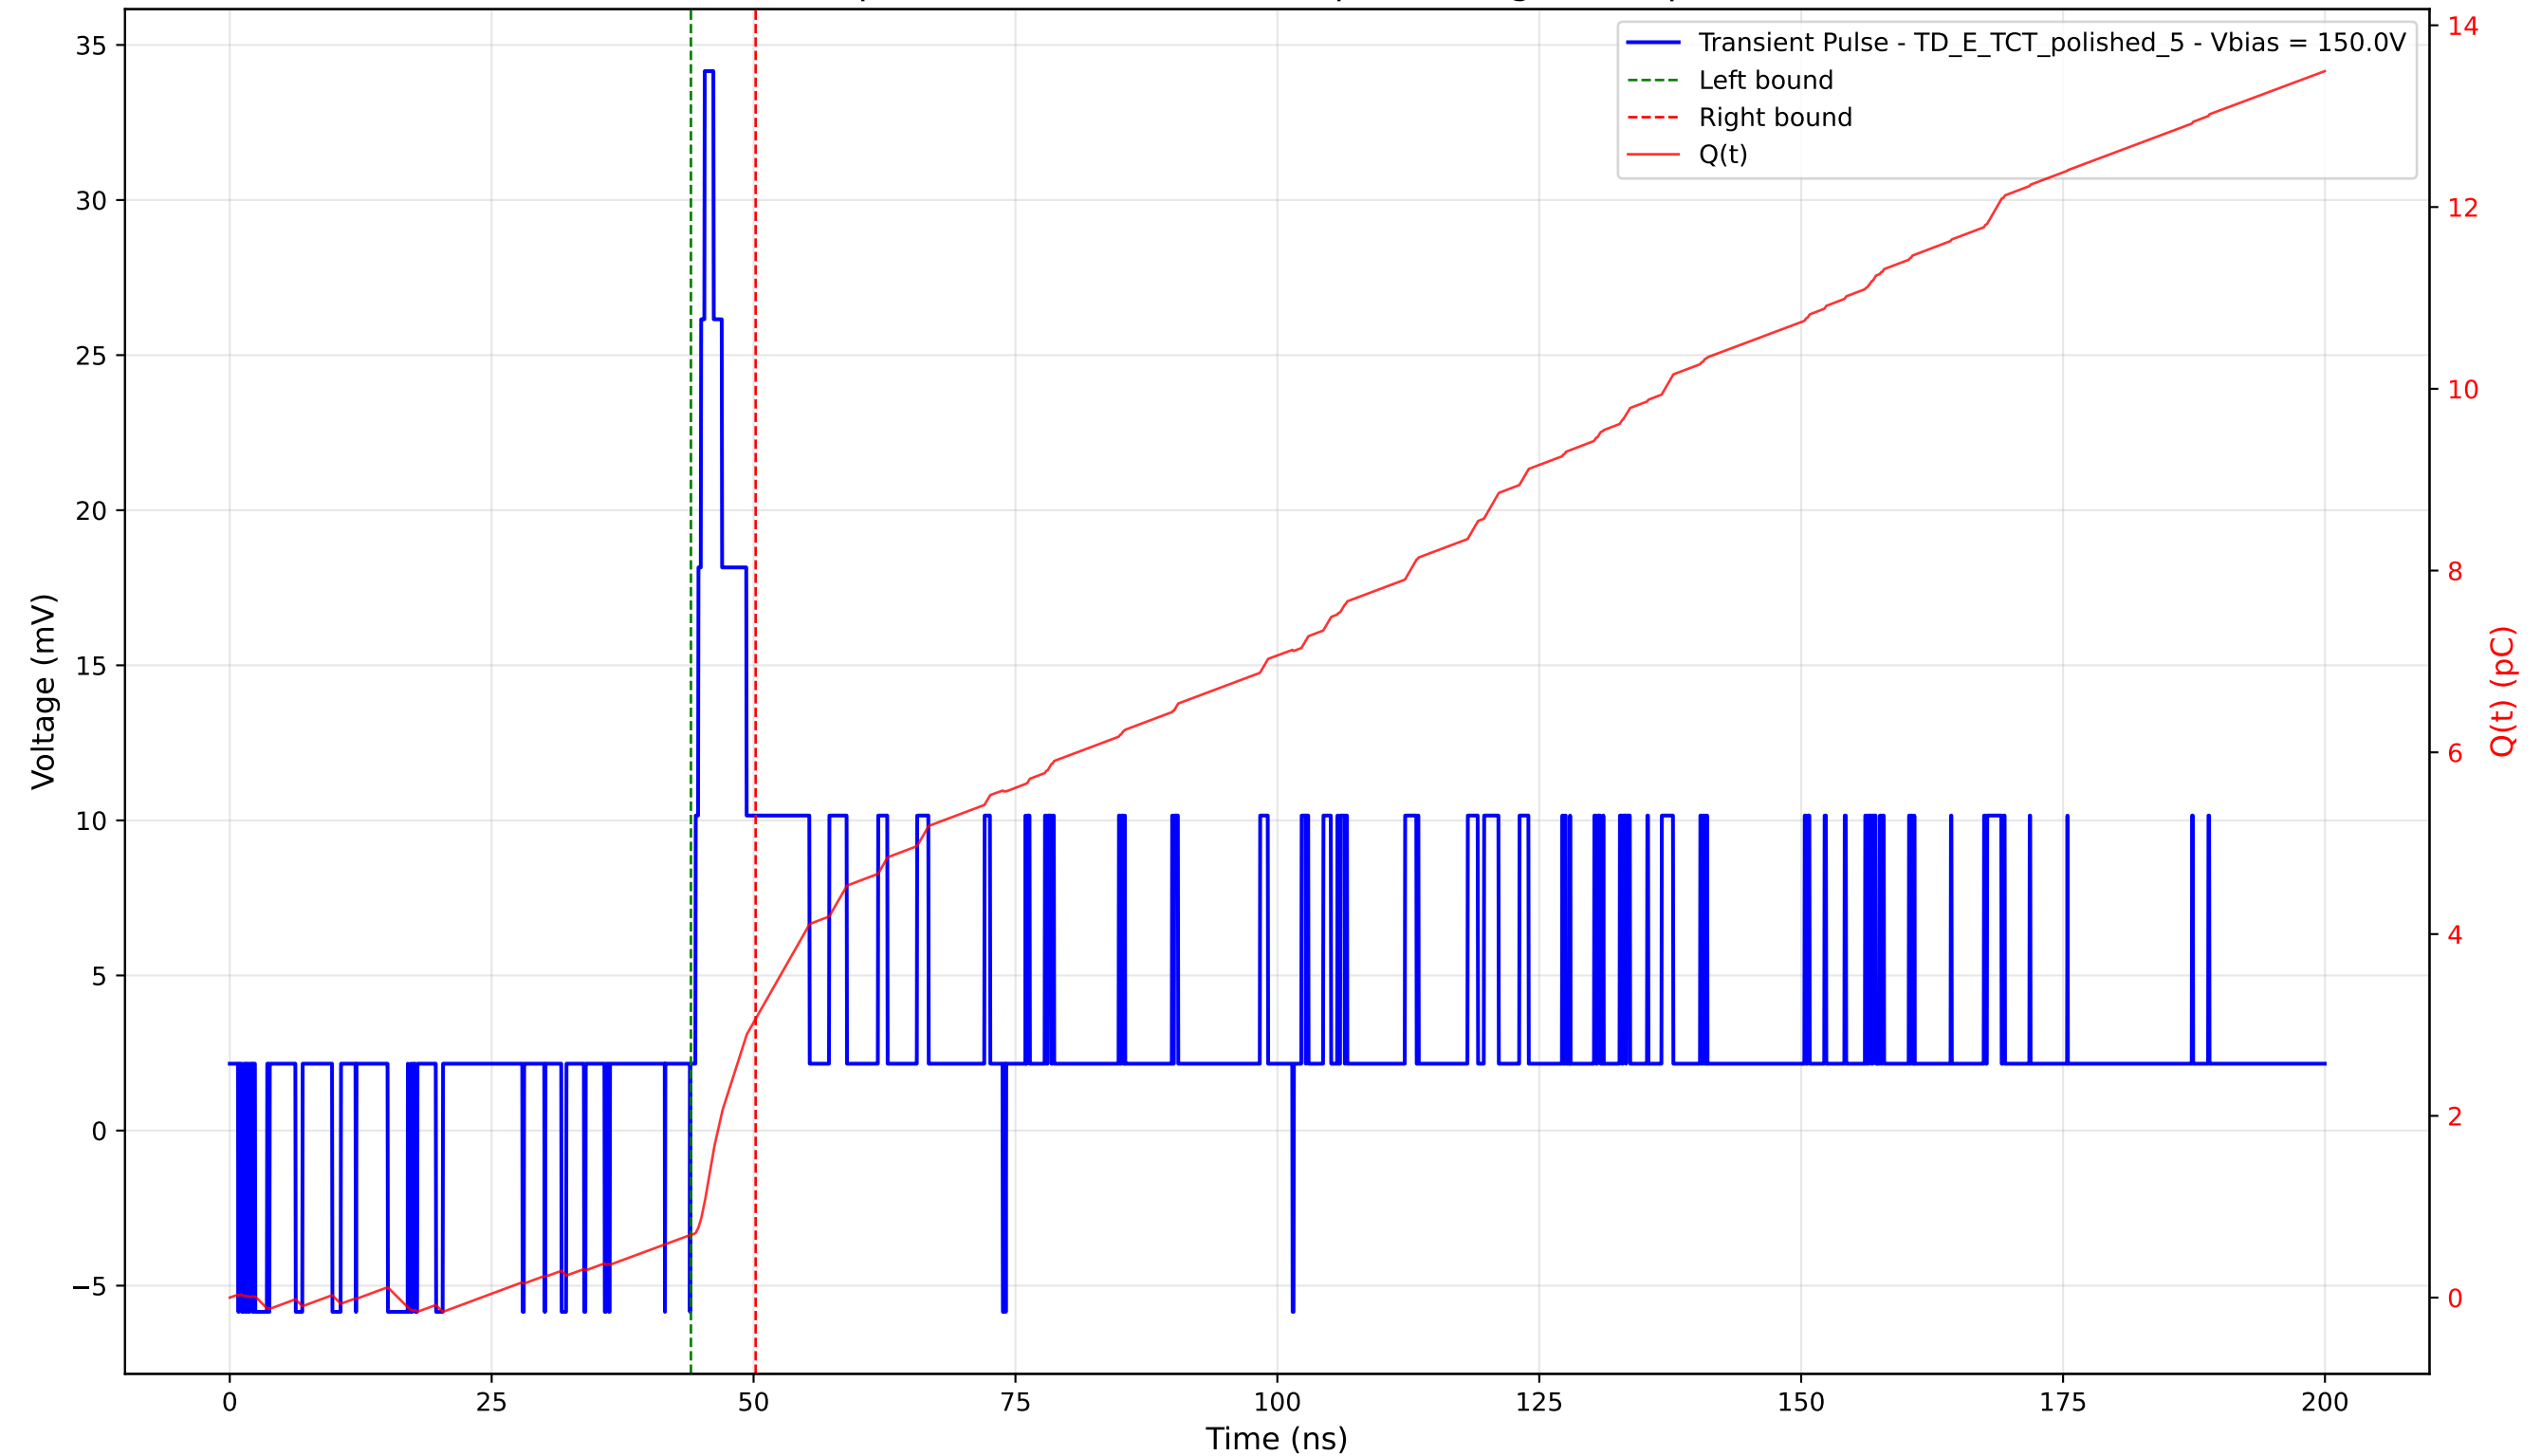


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 2.73 pC - Rise Time: 0.75 ns

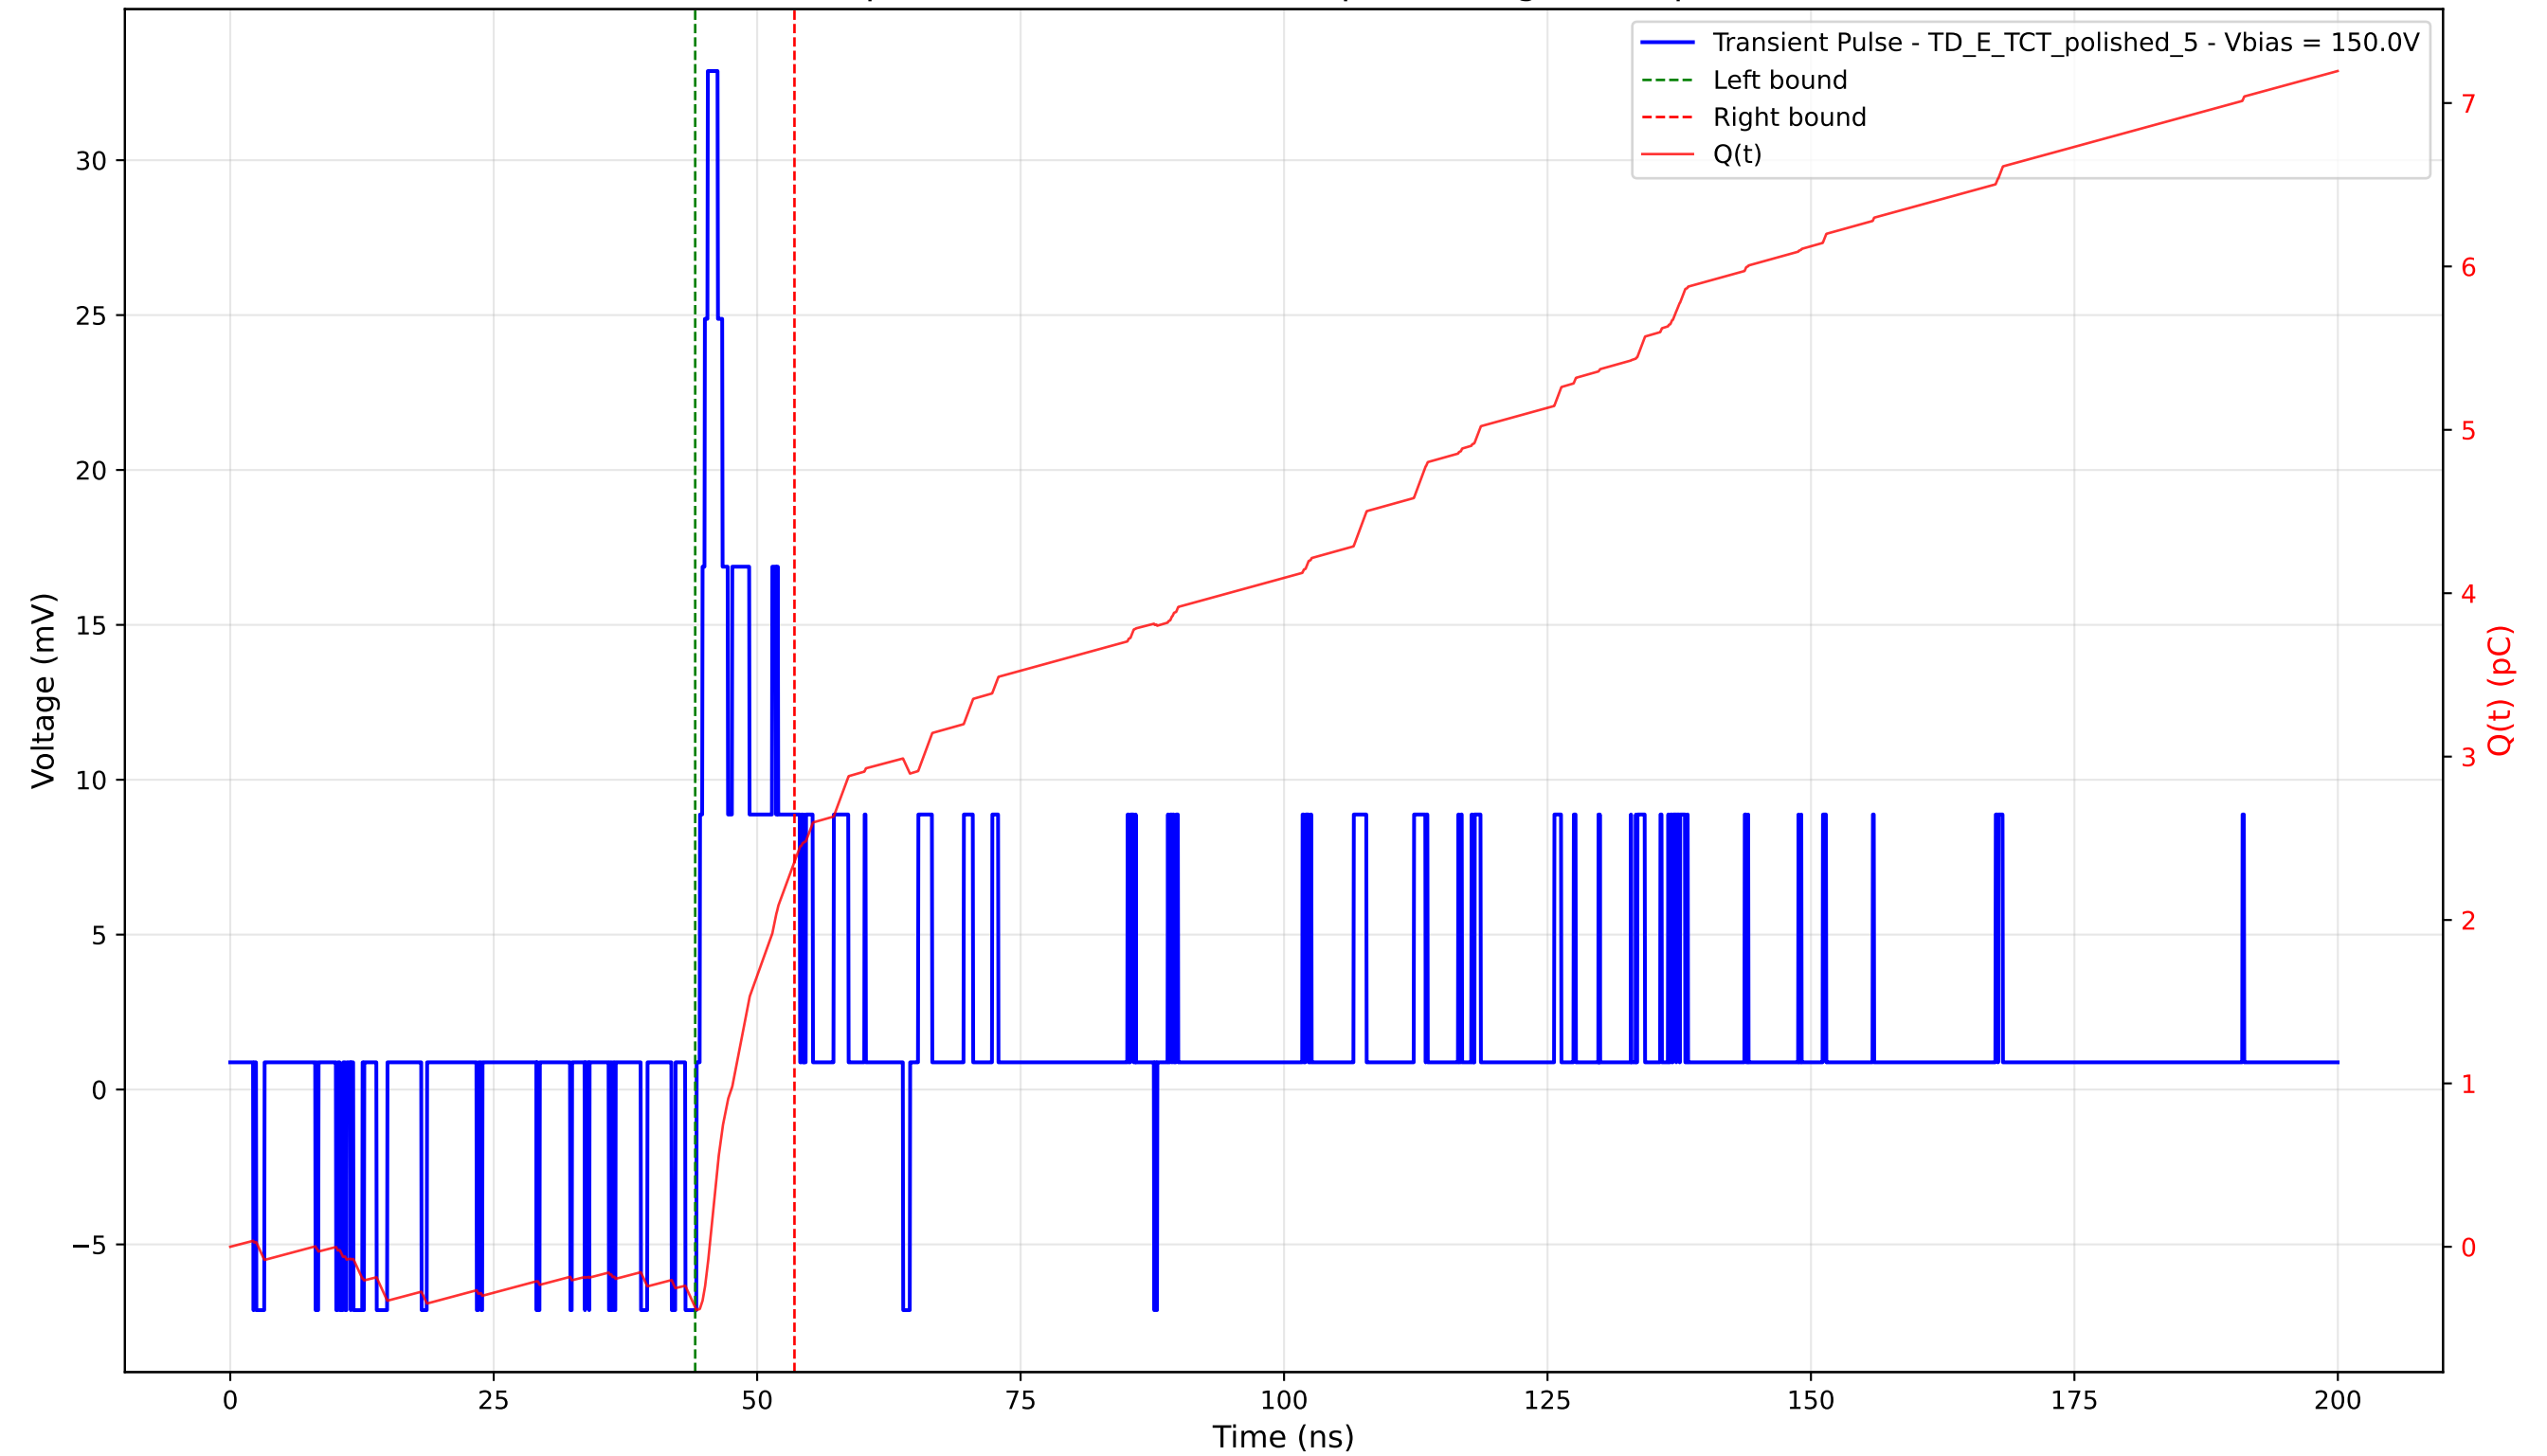


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 2.90 pC - Rise Time: 0.95 ns

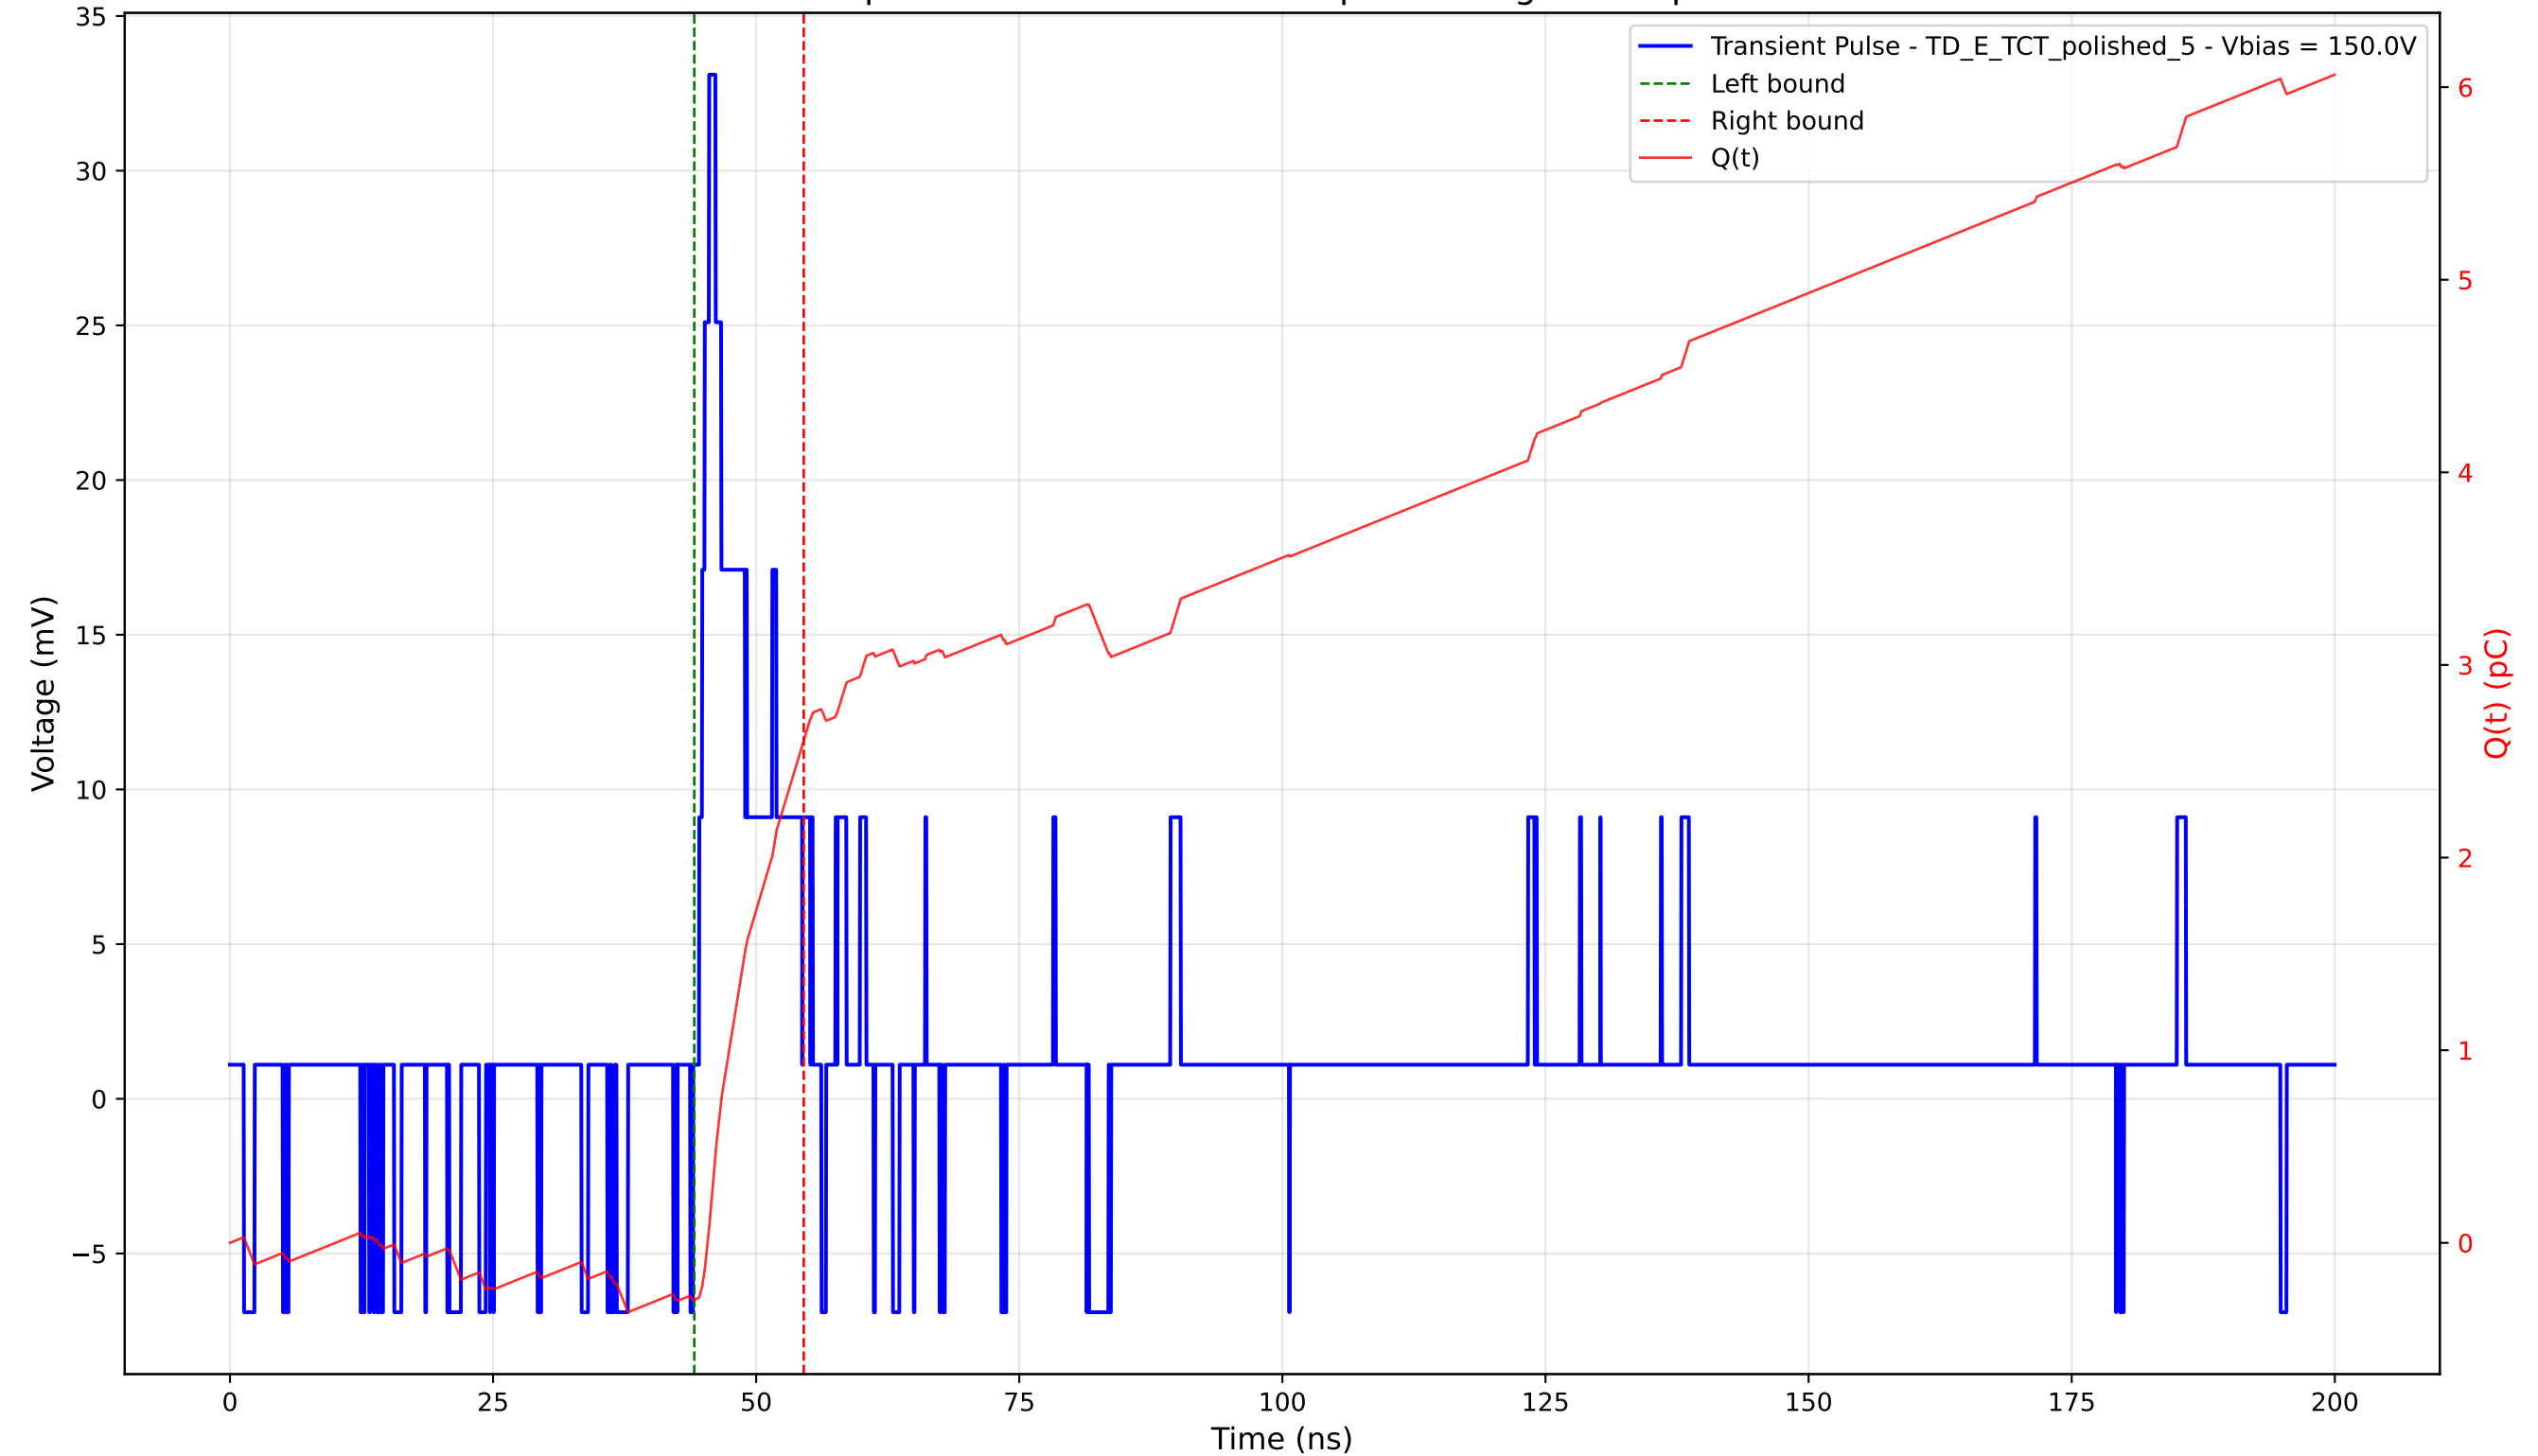


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 2.77 pC - Rise Time: 1.15 ns

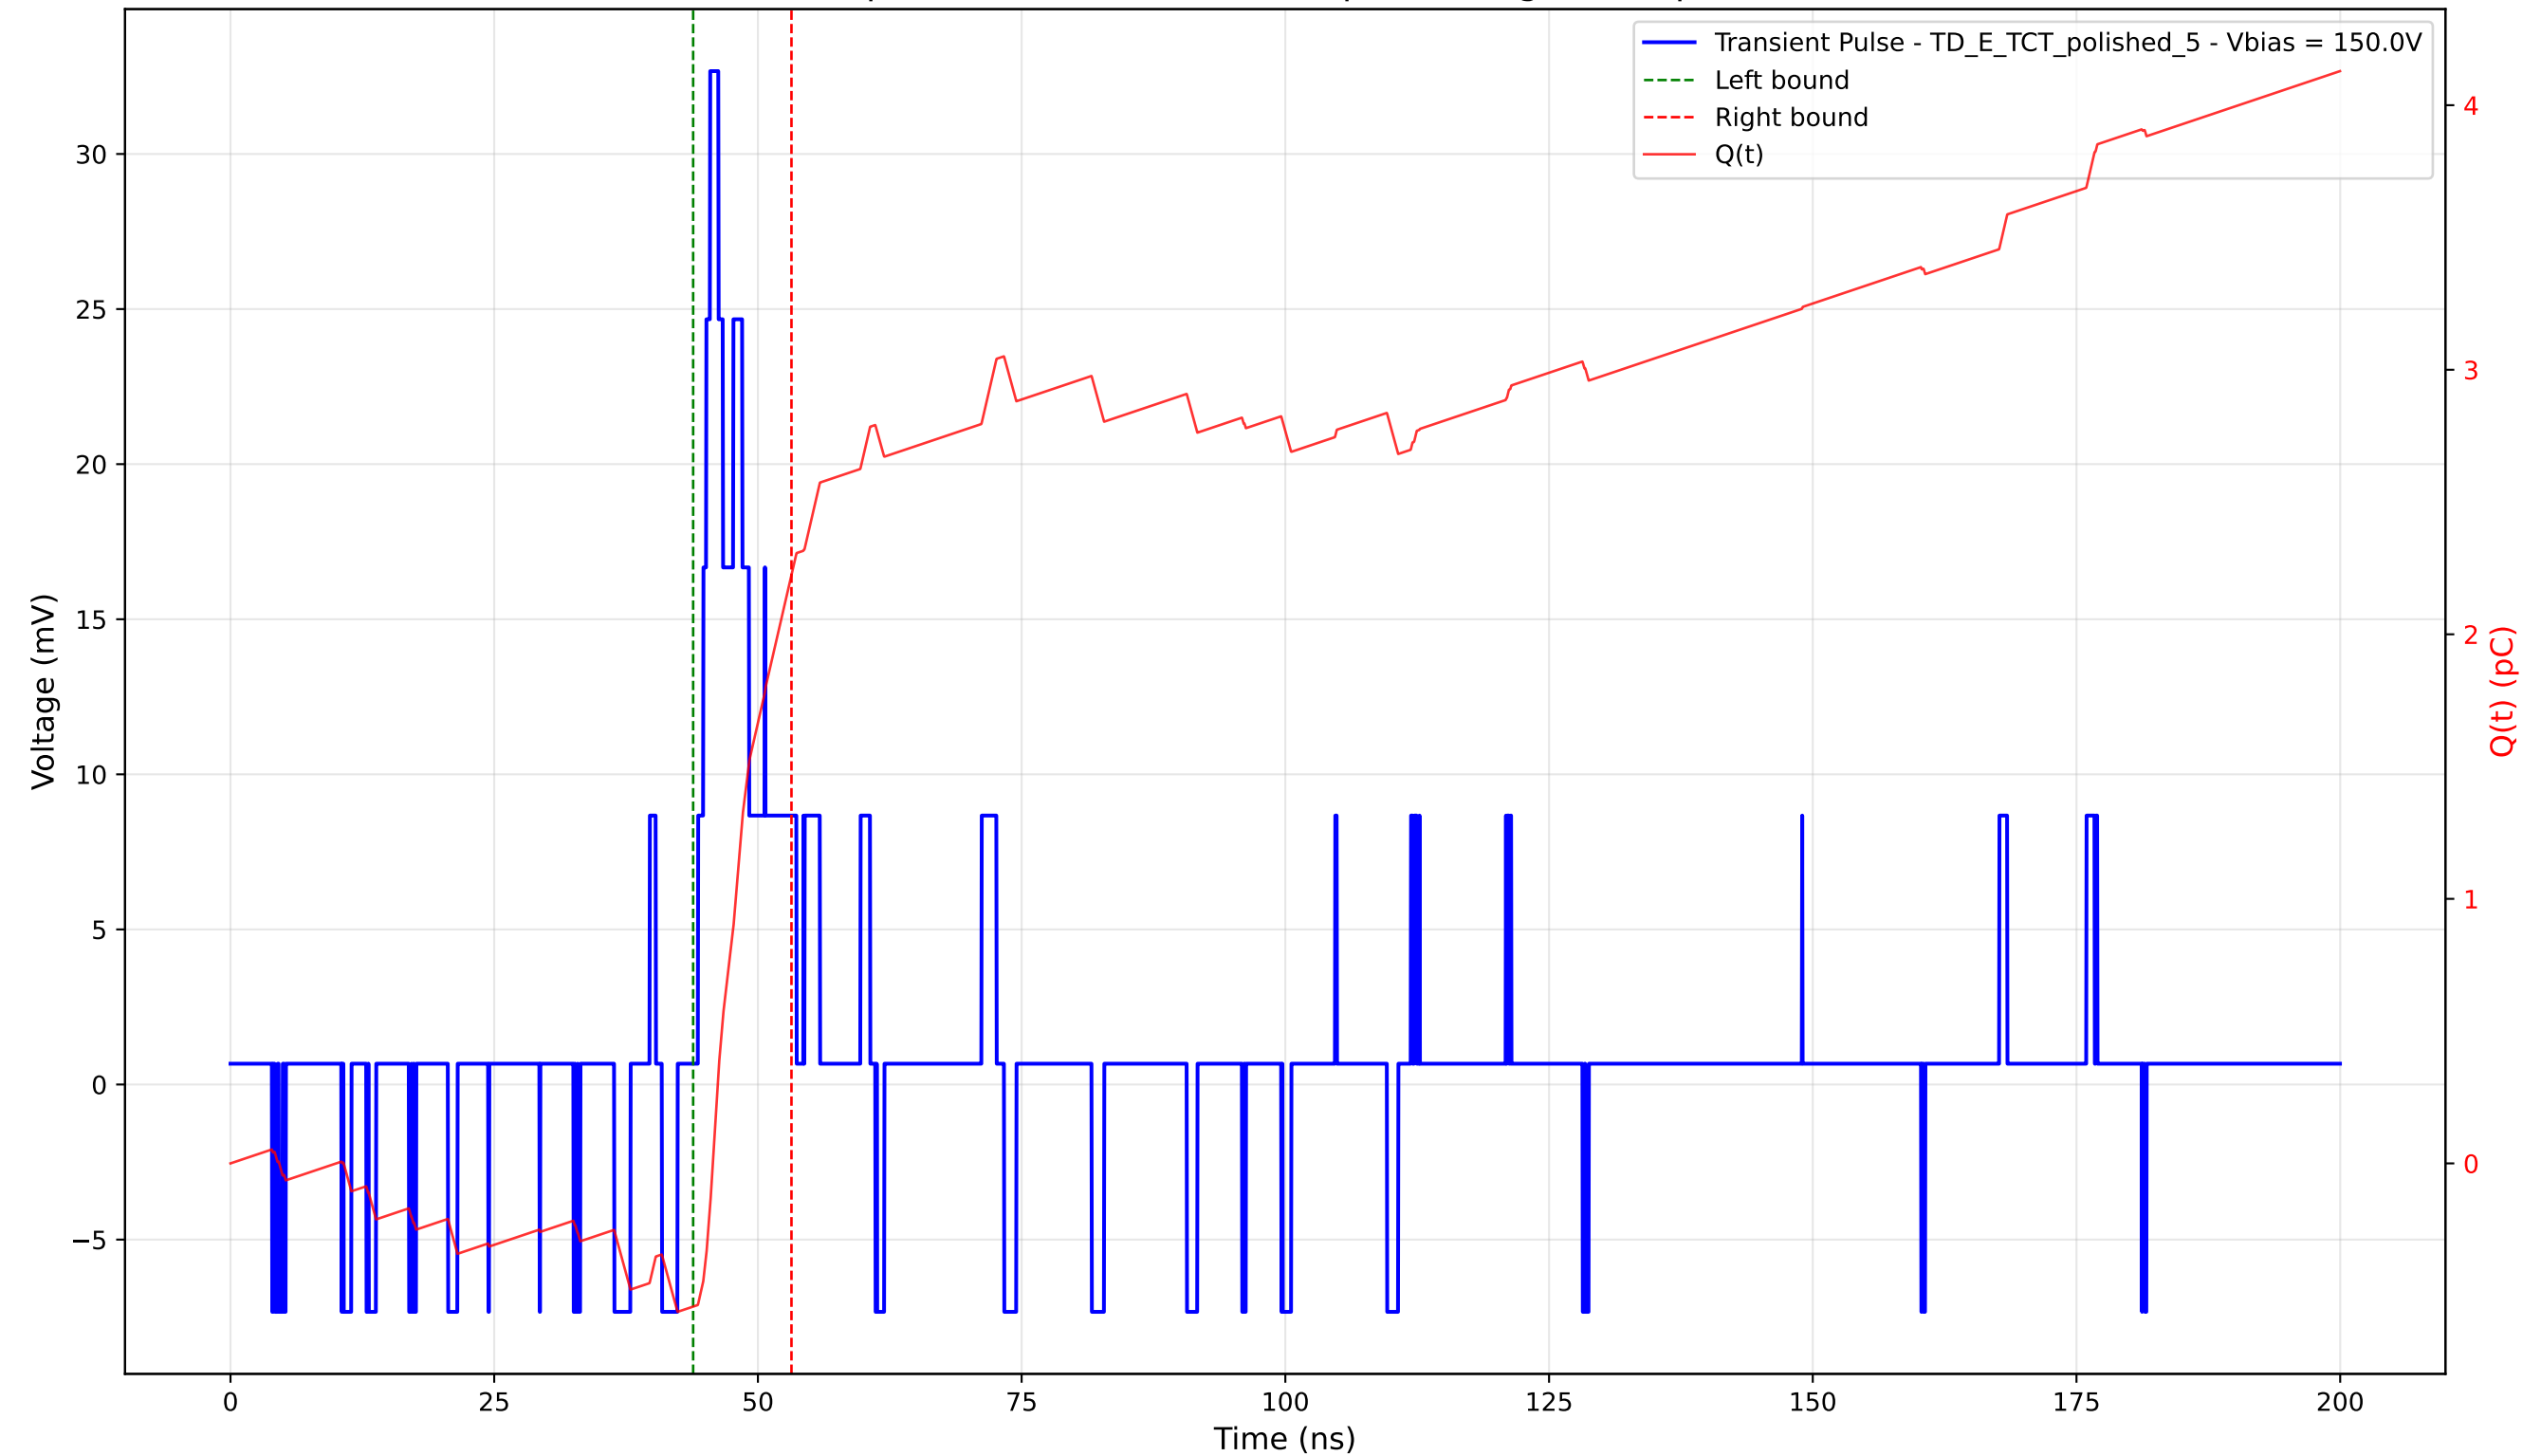


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 2.10 pC - Rise Time: 0.76 ns

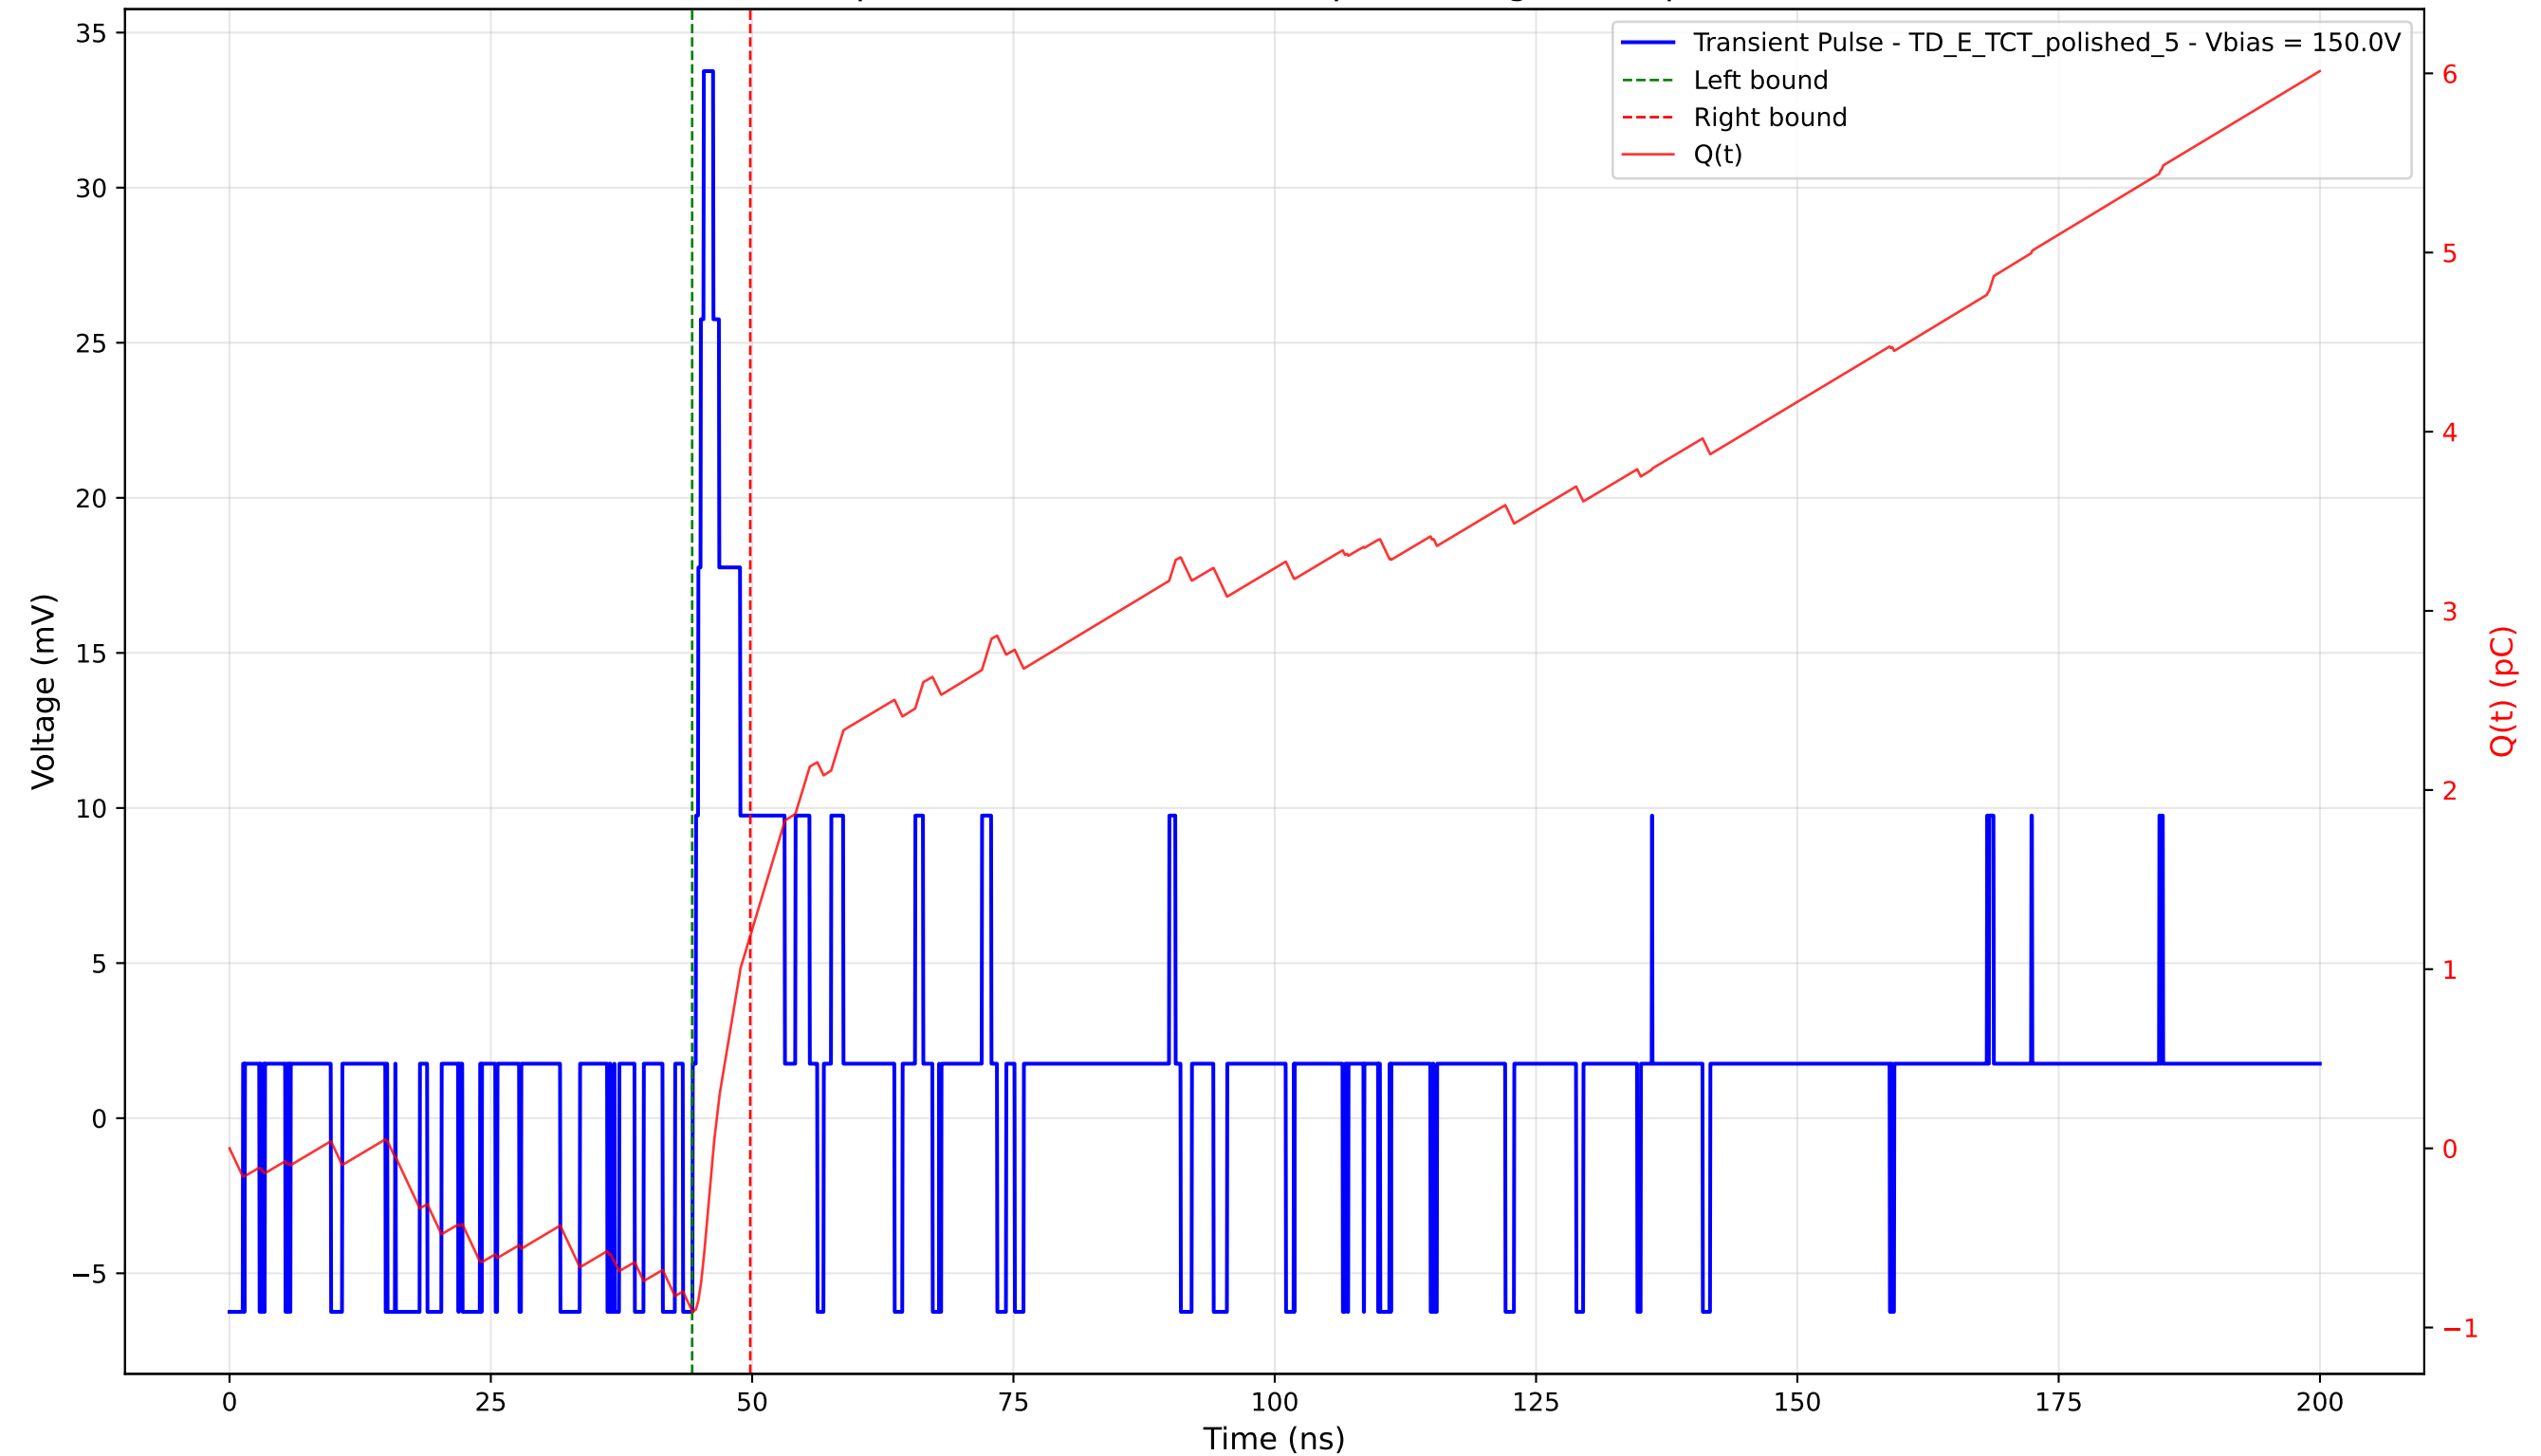


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 3.02 pC - Rise Time: 0.73 ns

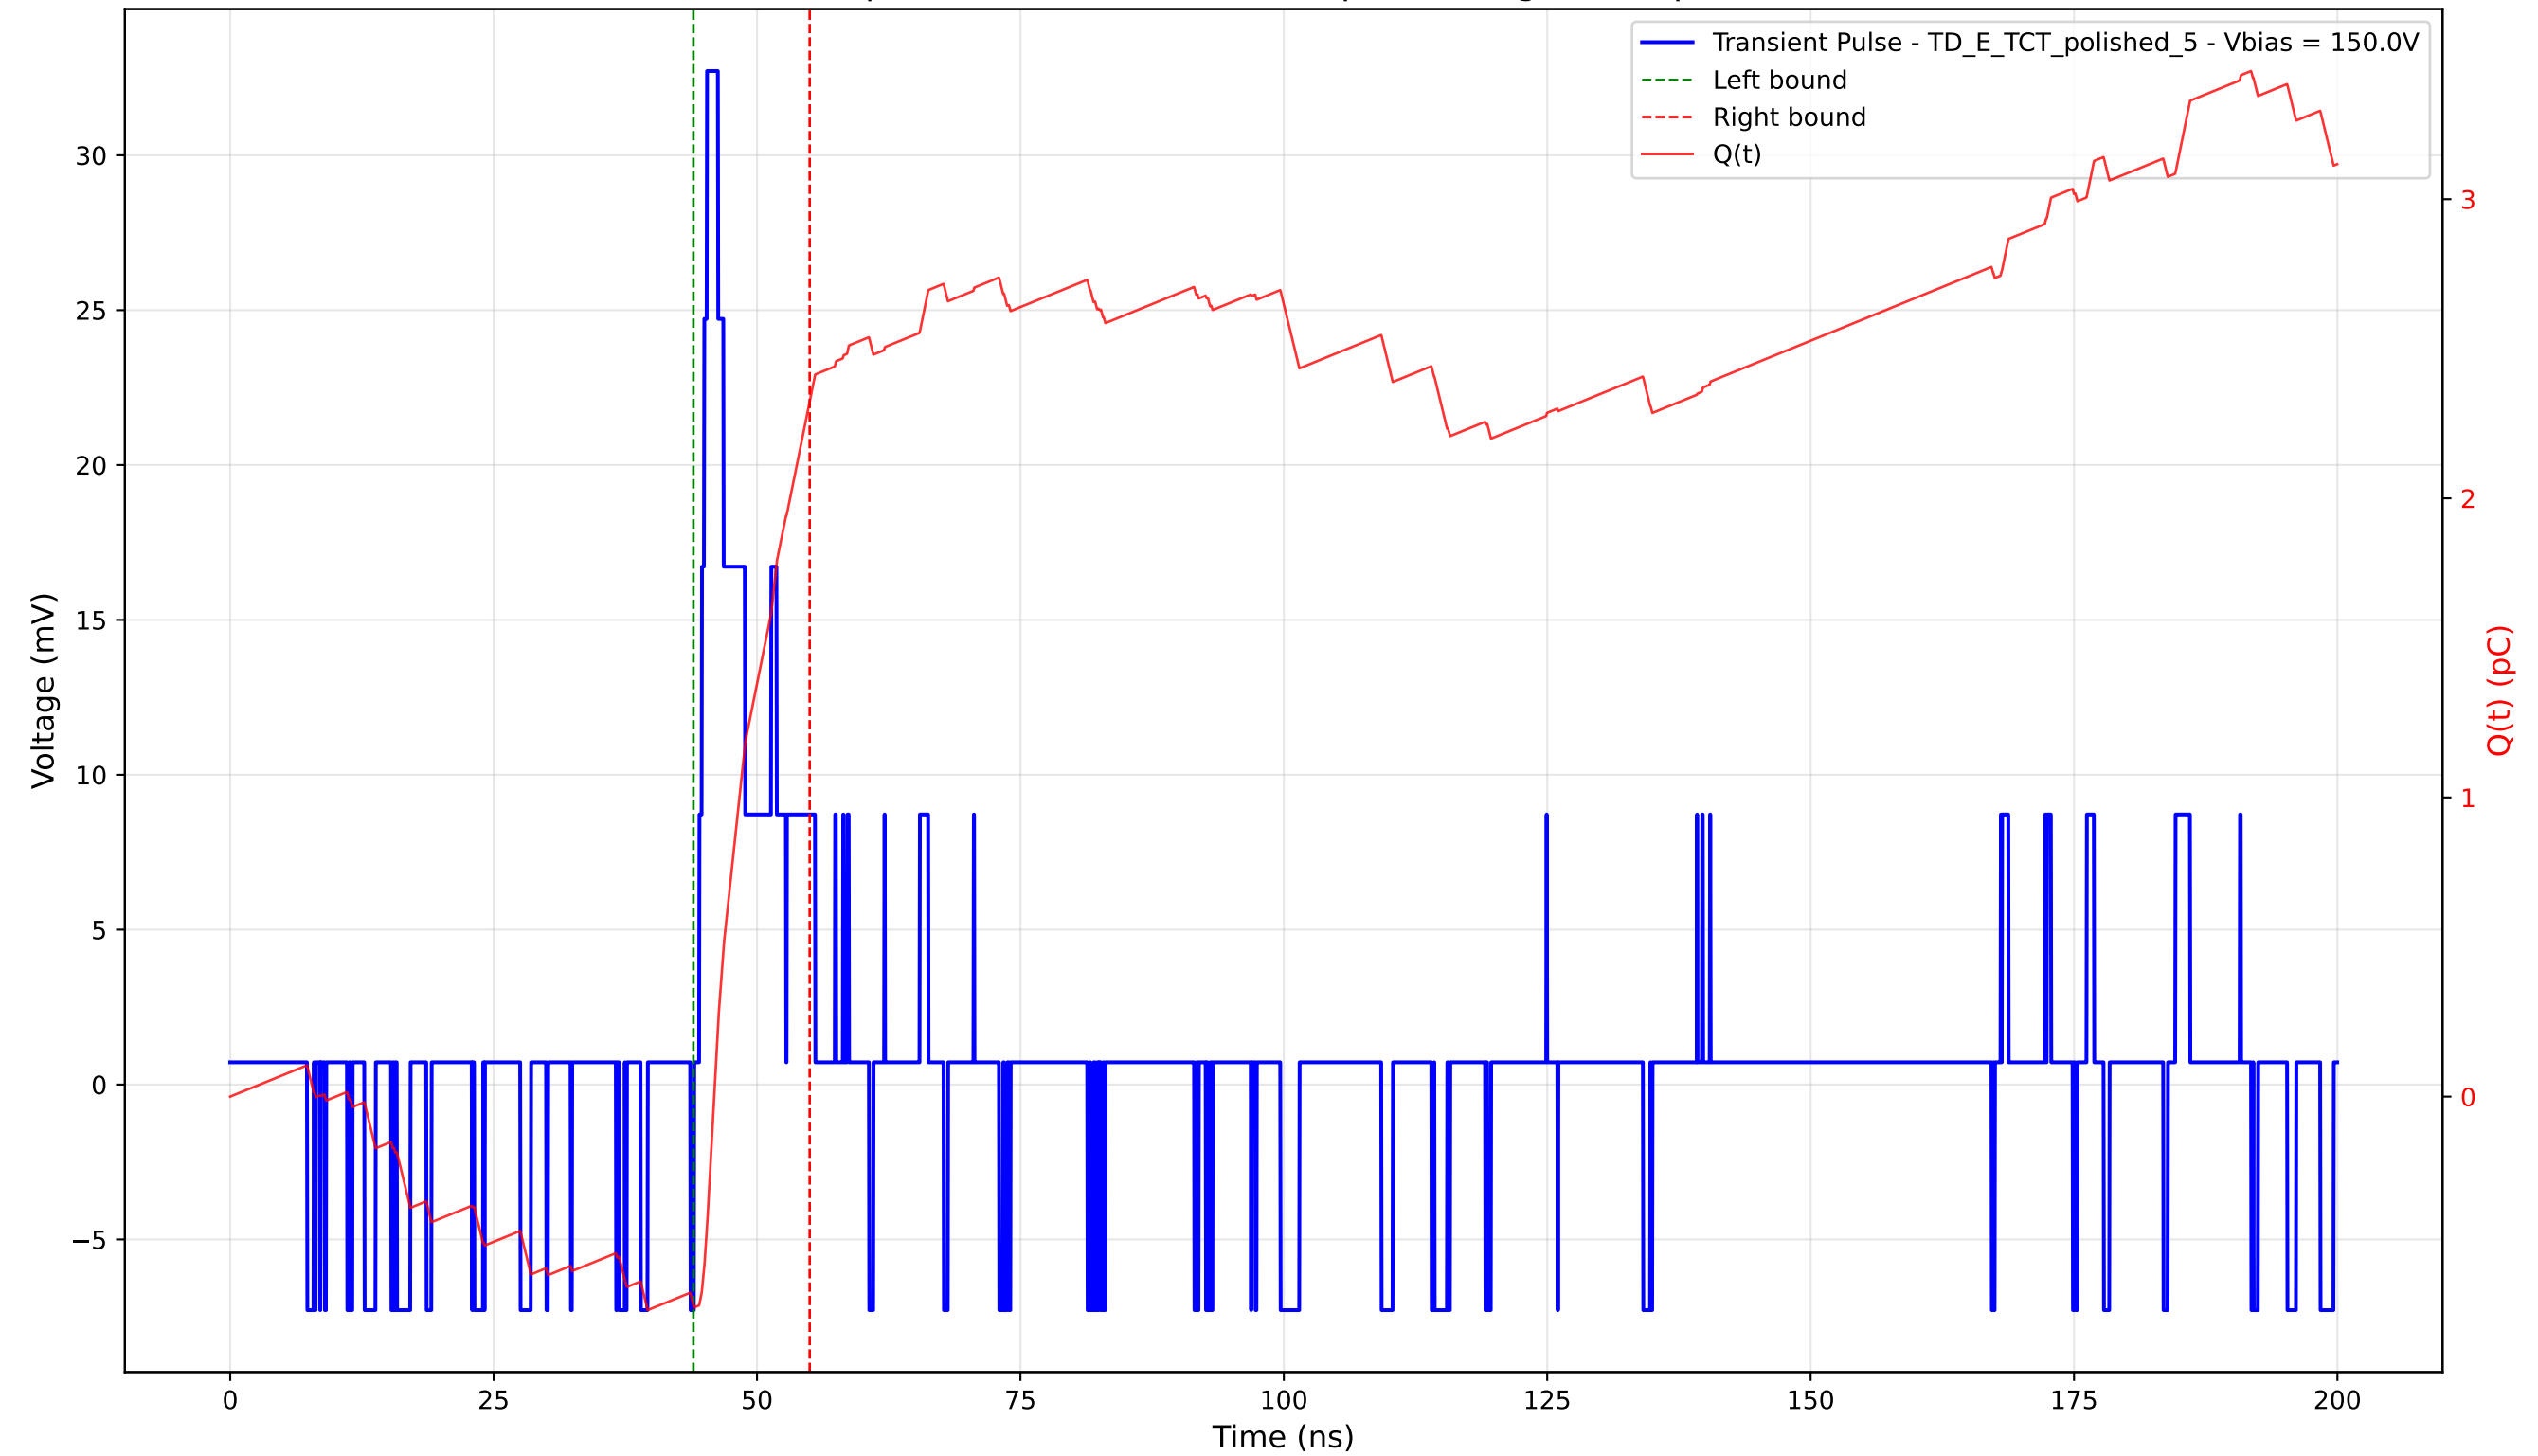


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.21 pC - Rise Time: 0.84 ns

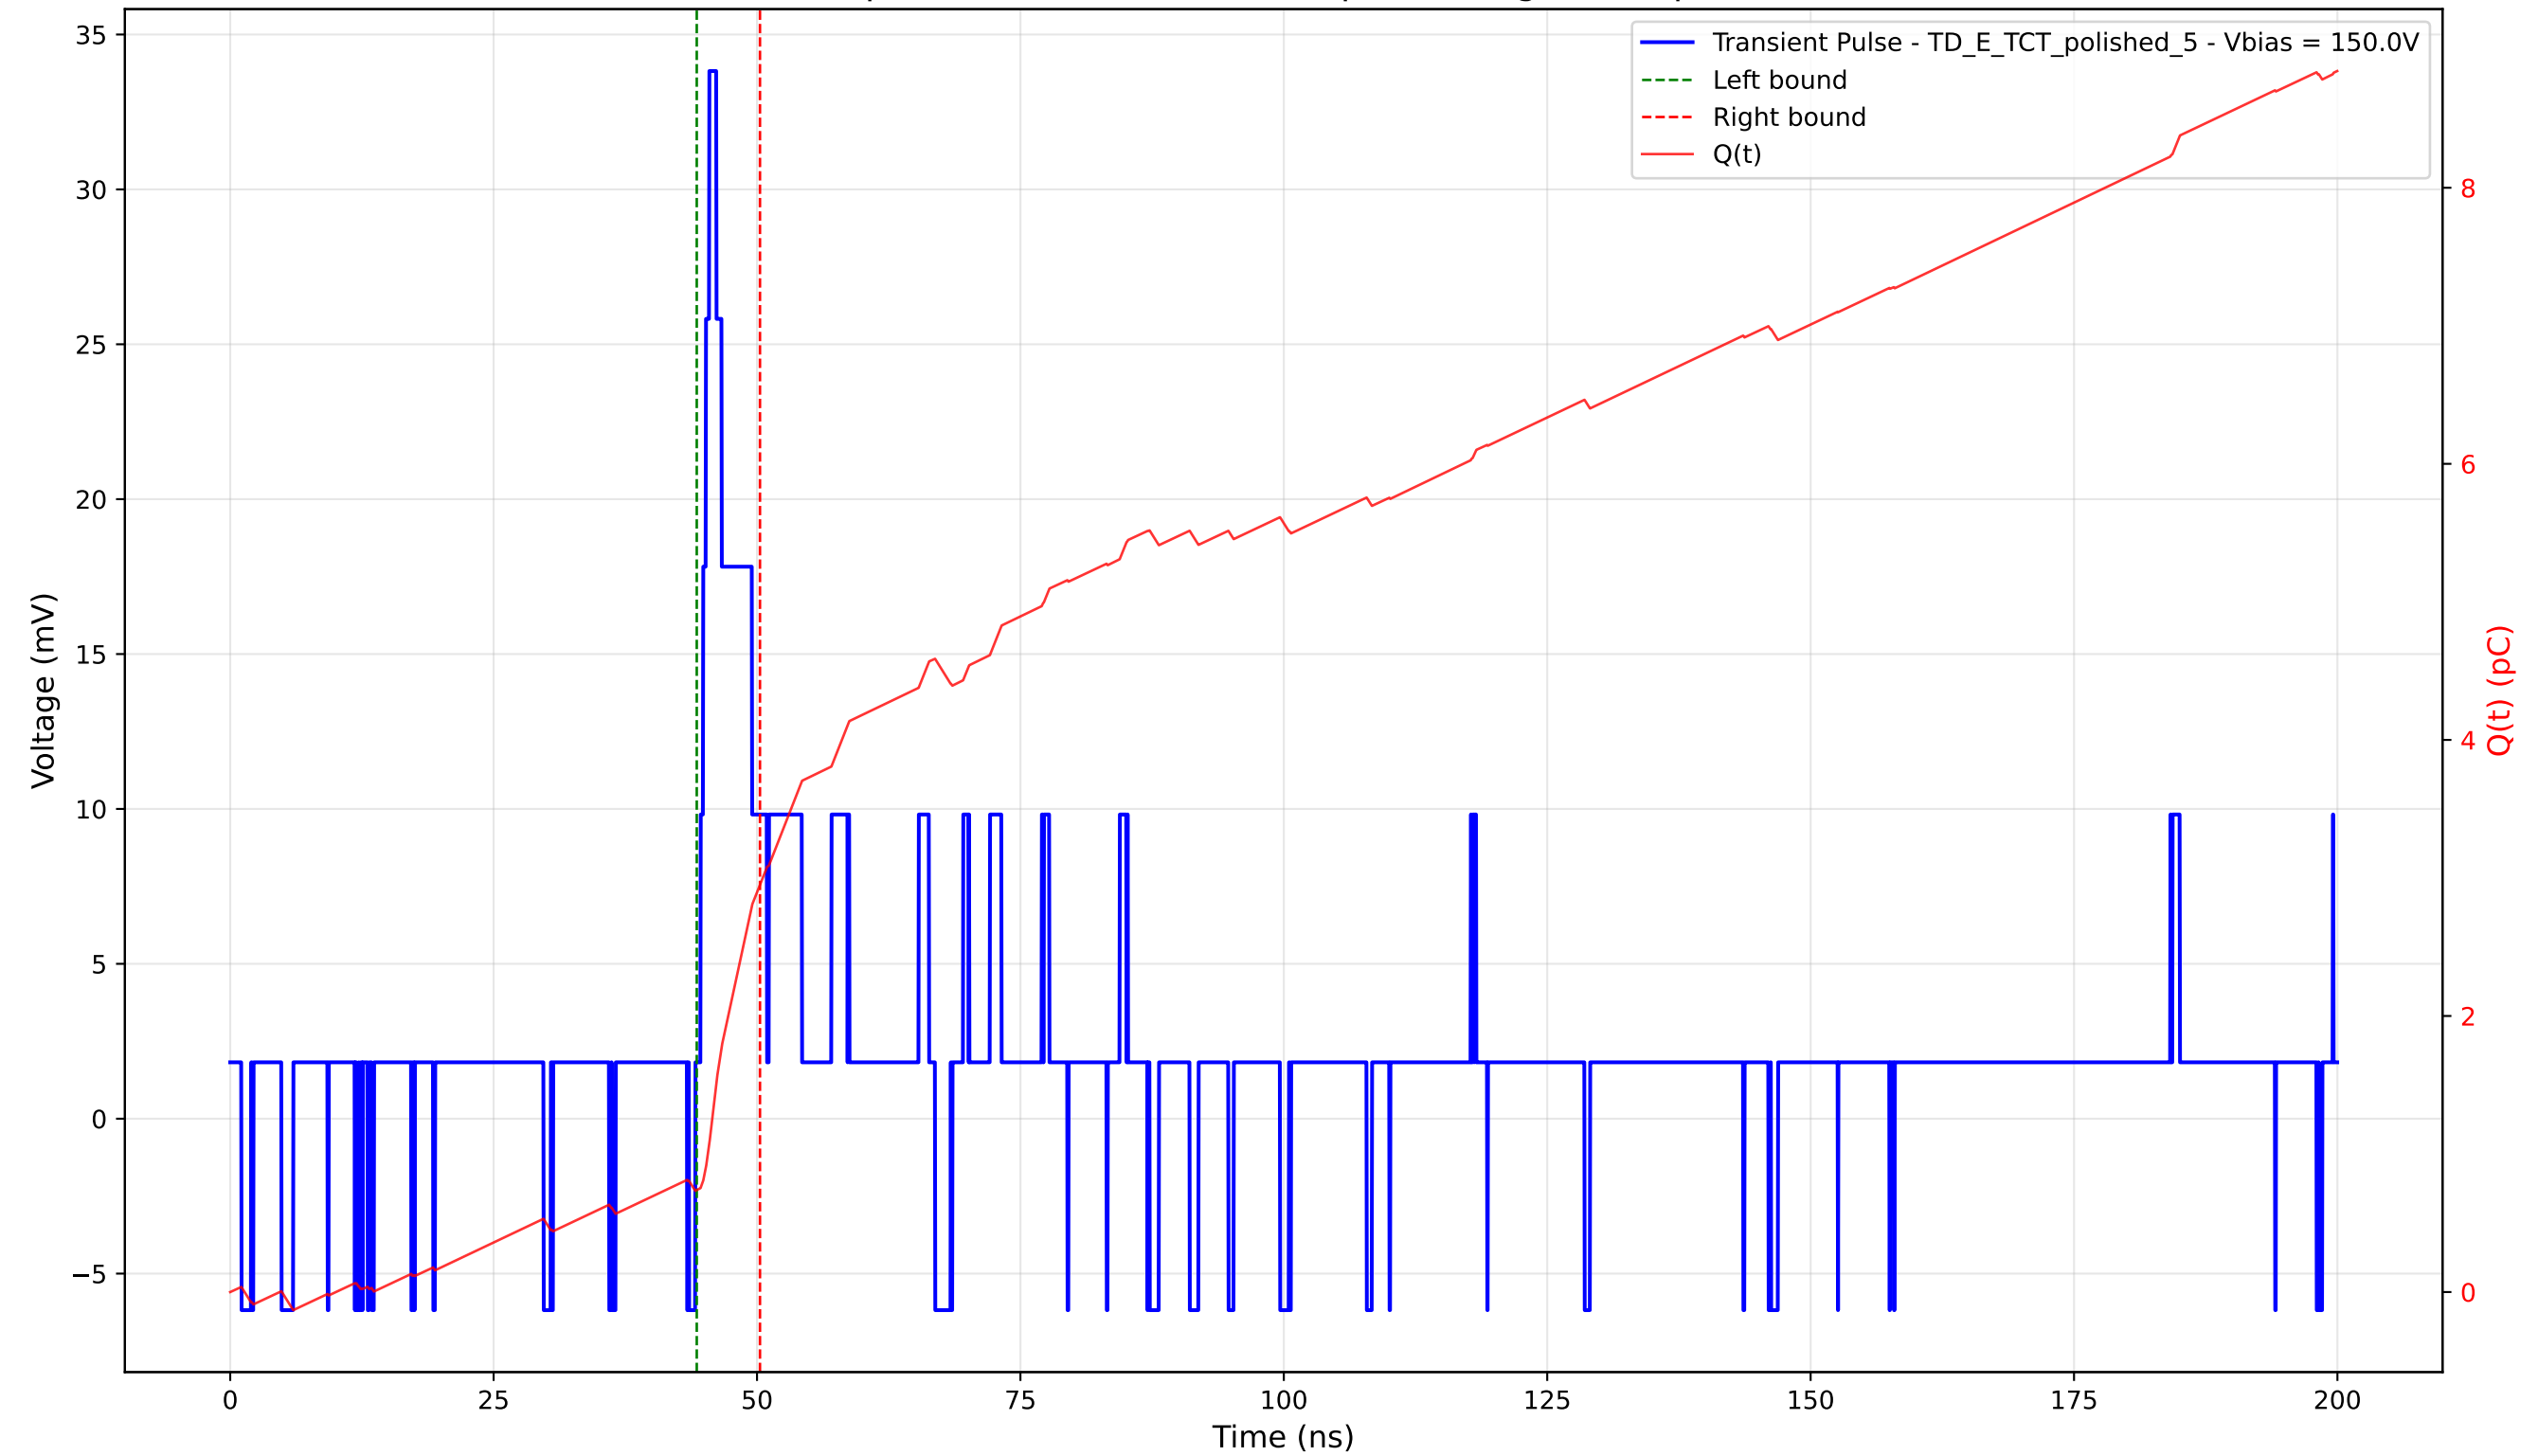


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 2.81 pC - Rise Time: 1.21 ns

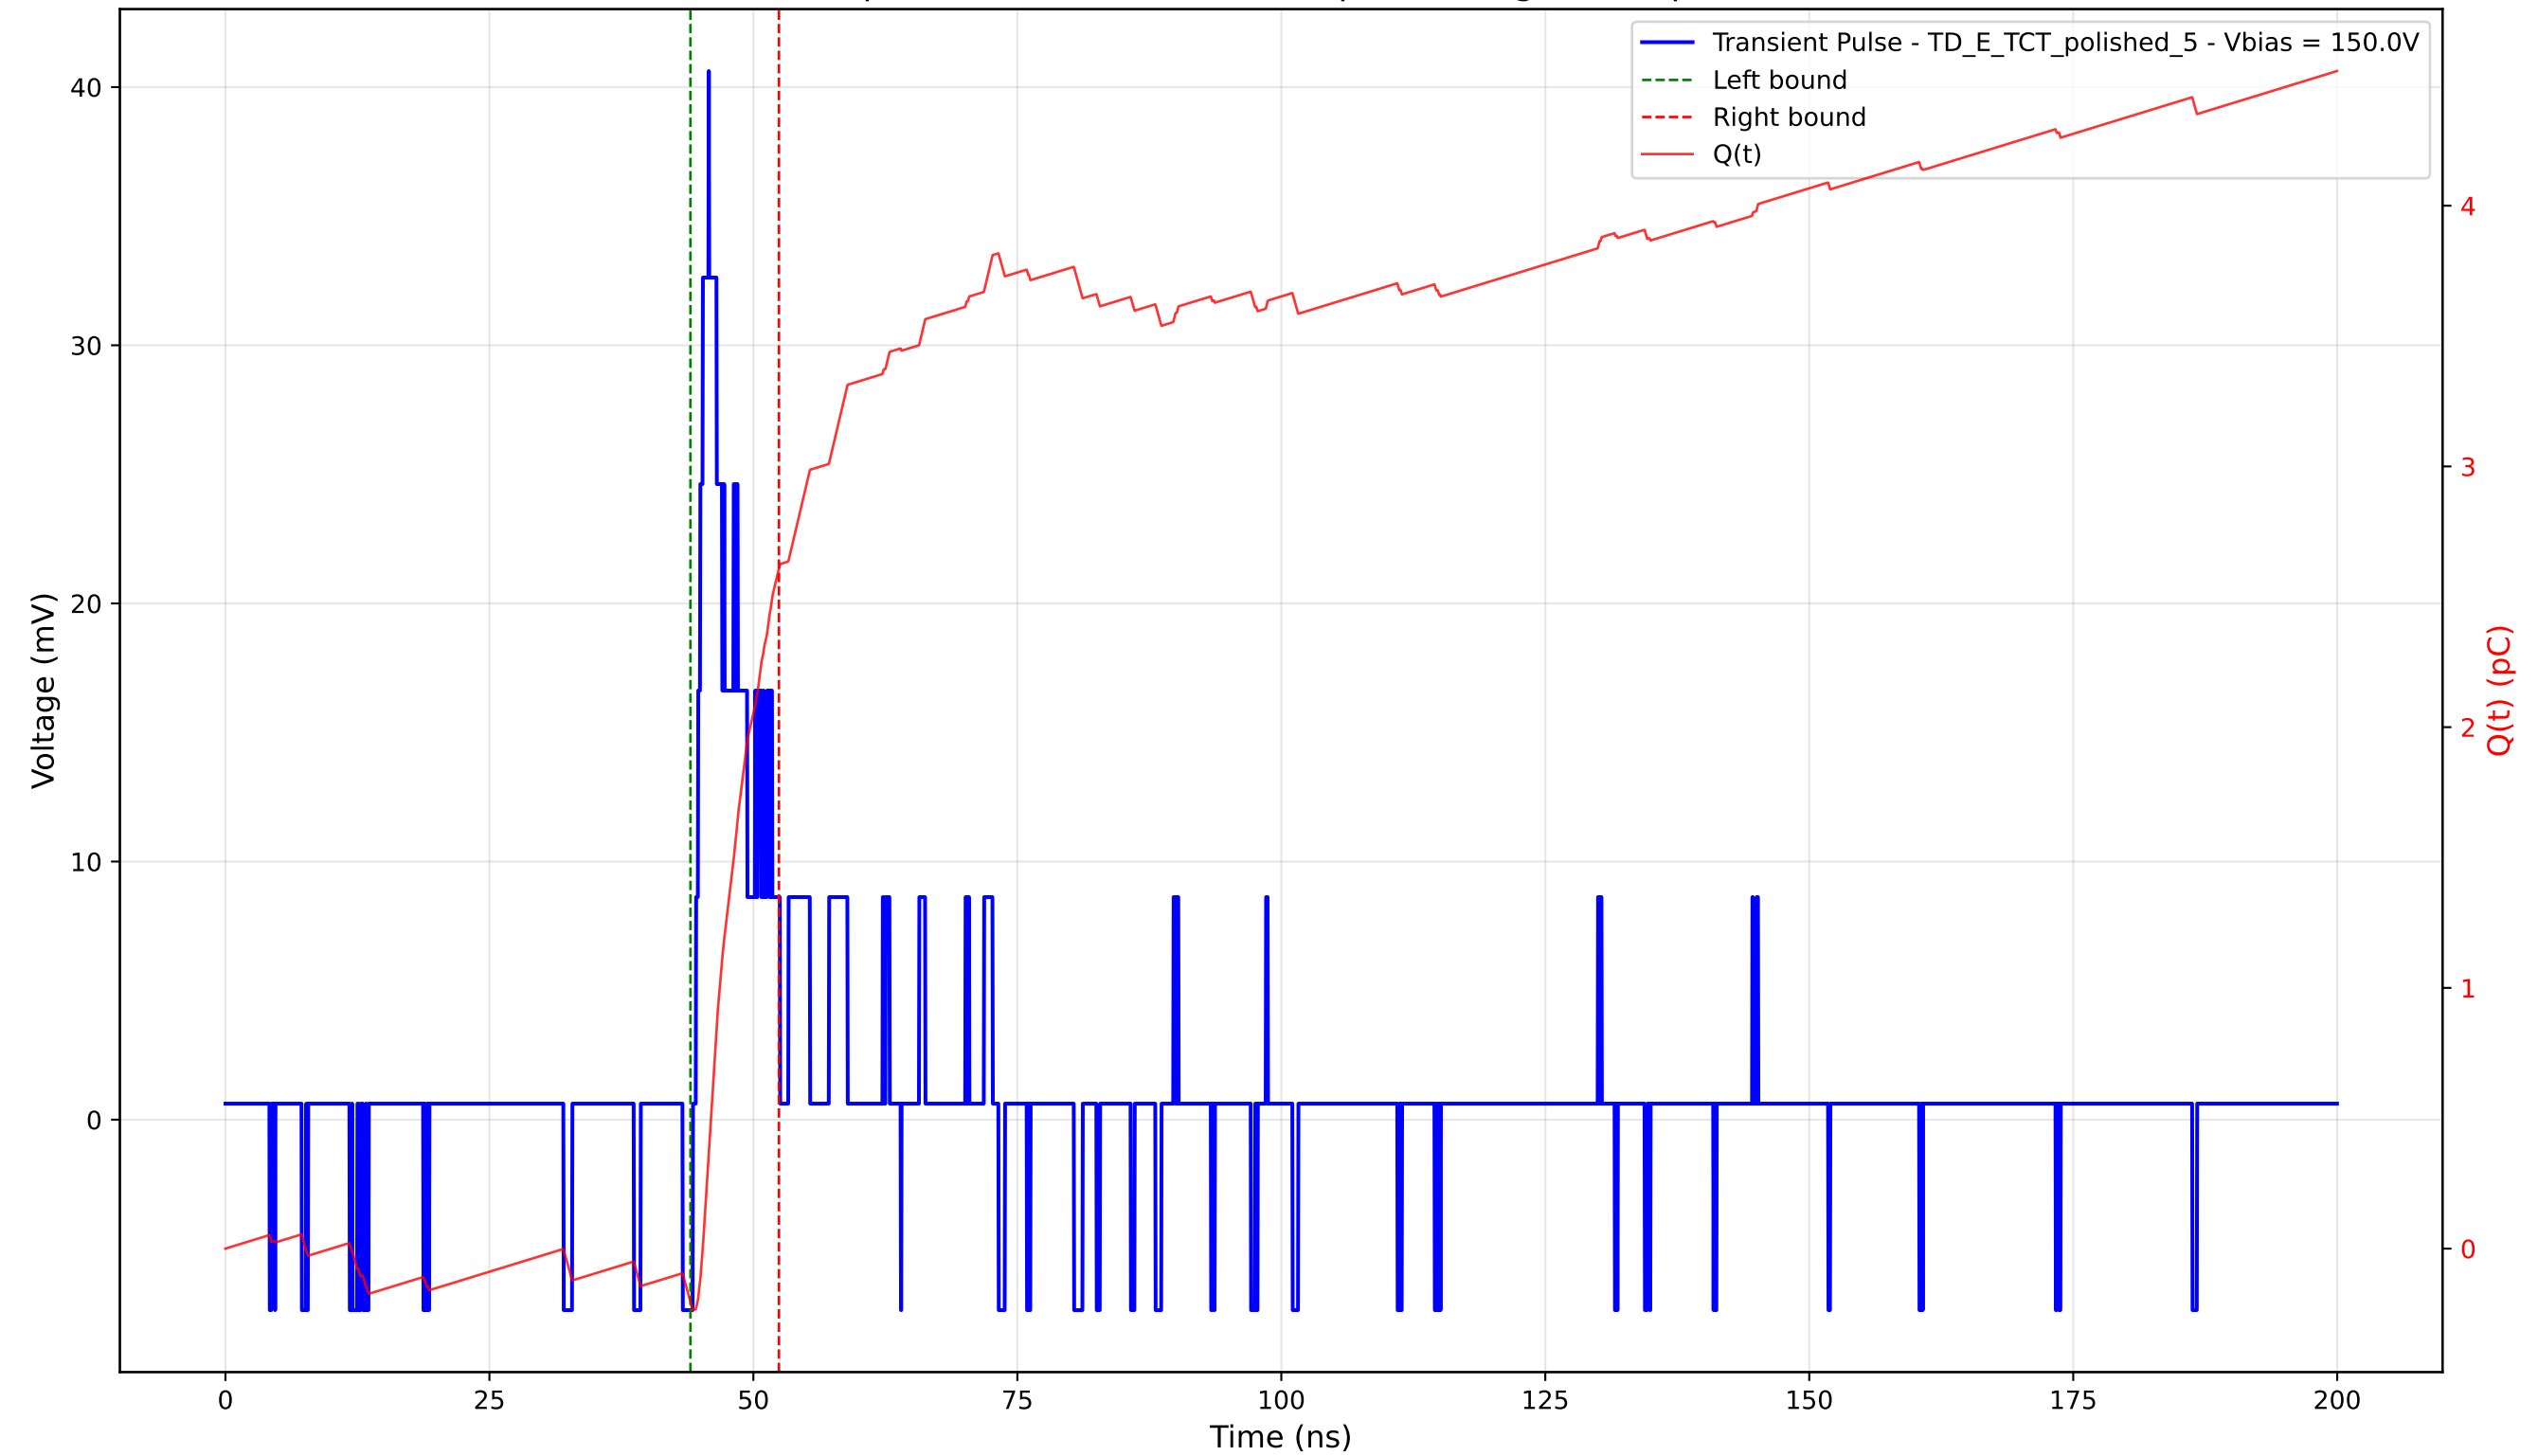


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 3.49 pC - Rise Time: 0.91 ns

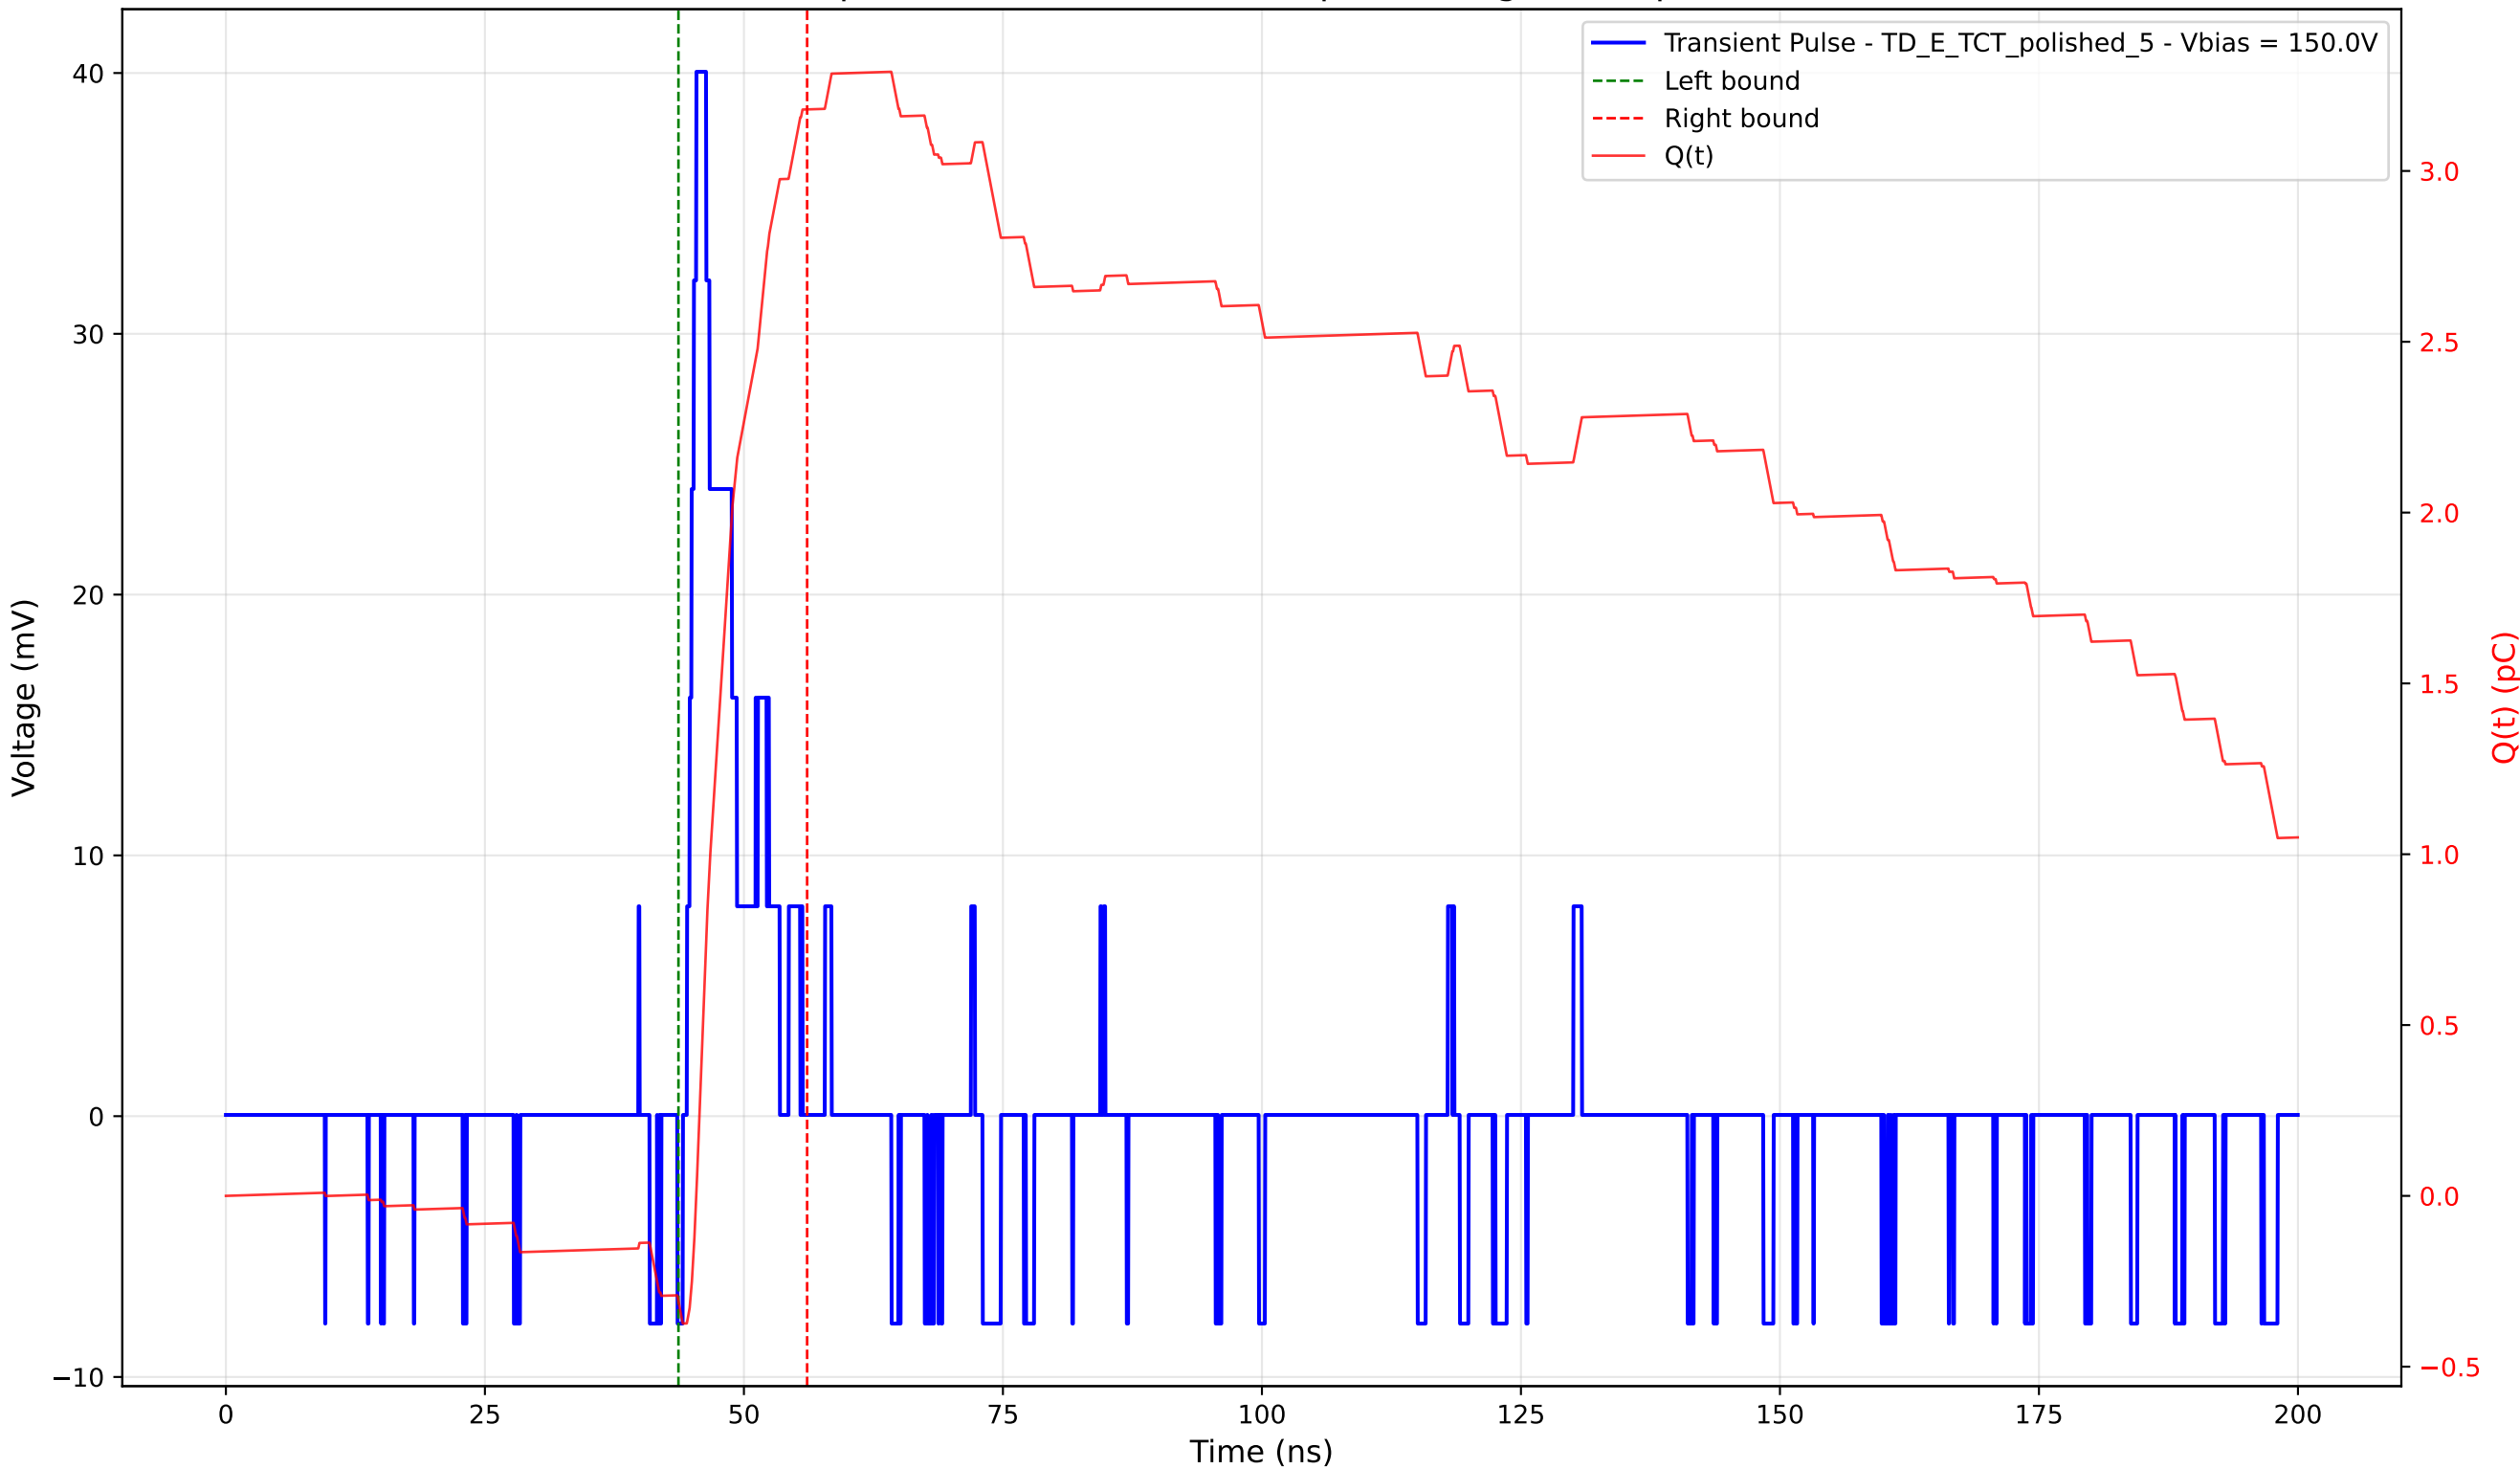


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 4.74 pC - Rise Time: 0.85 ns

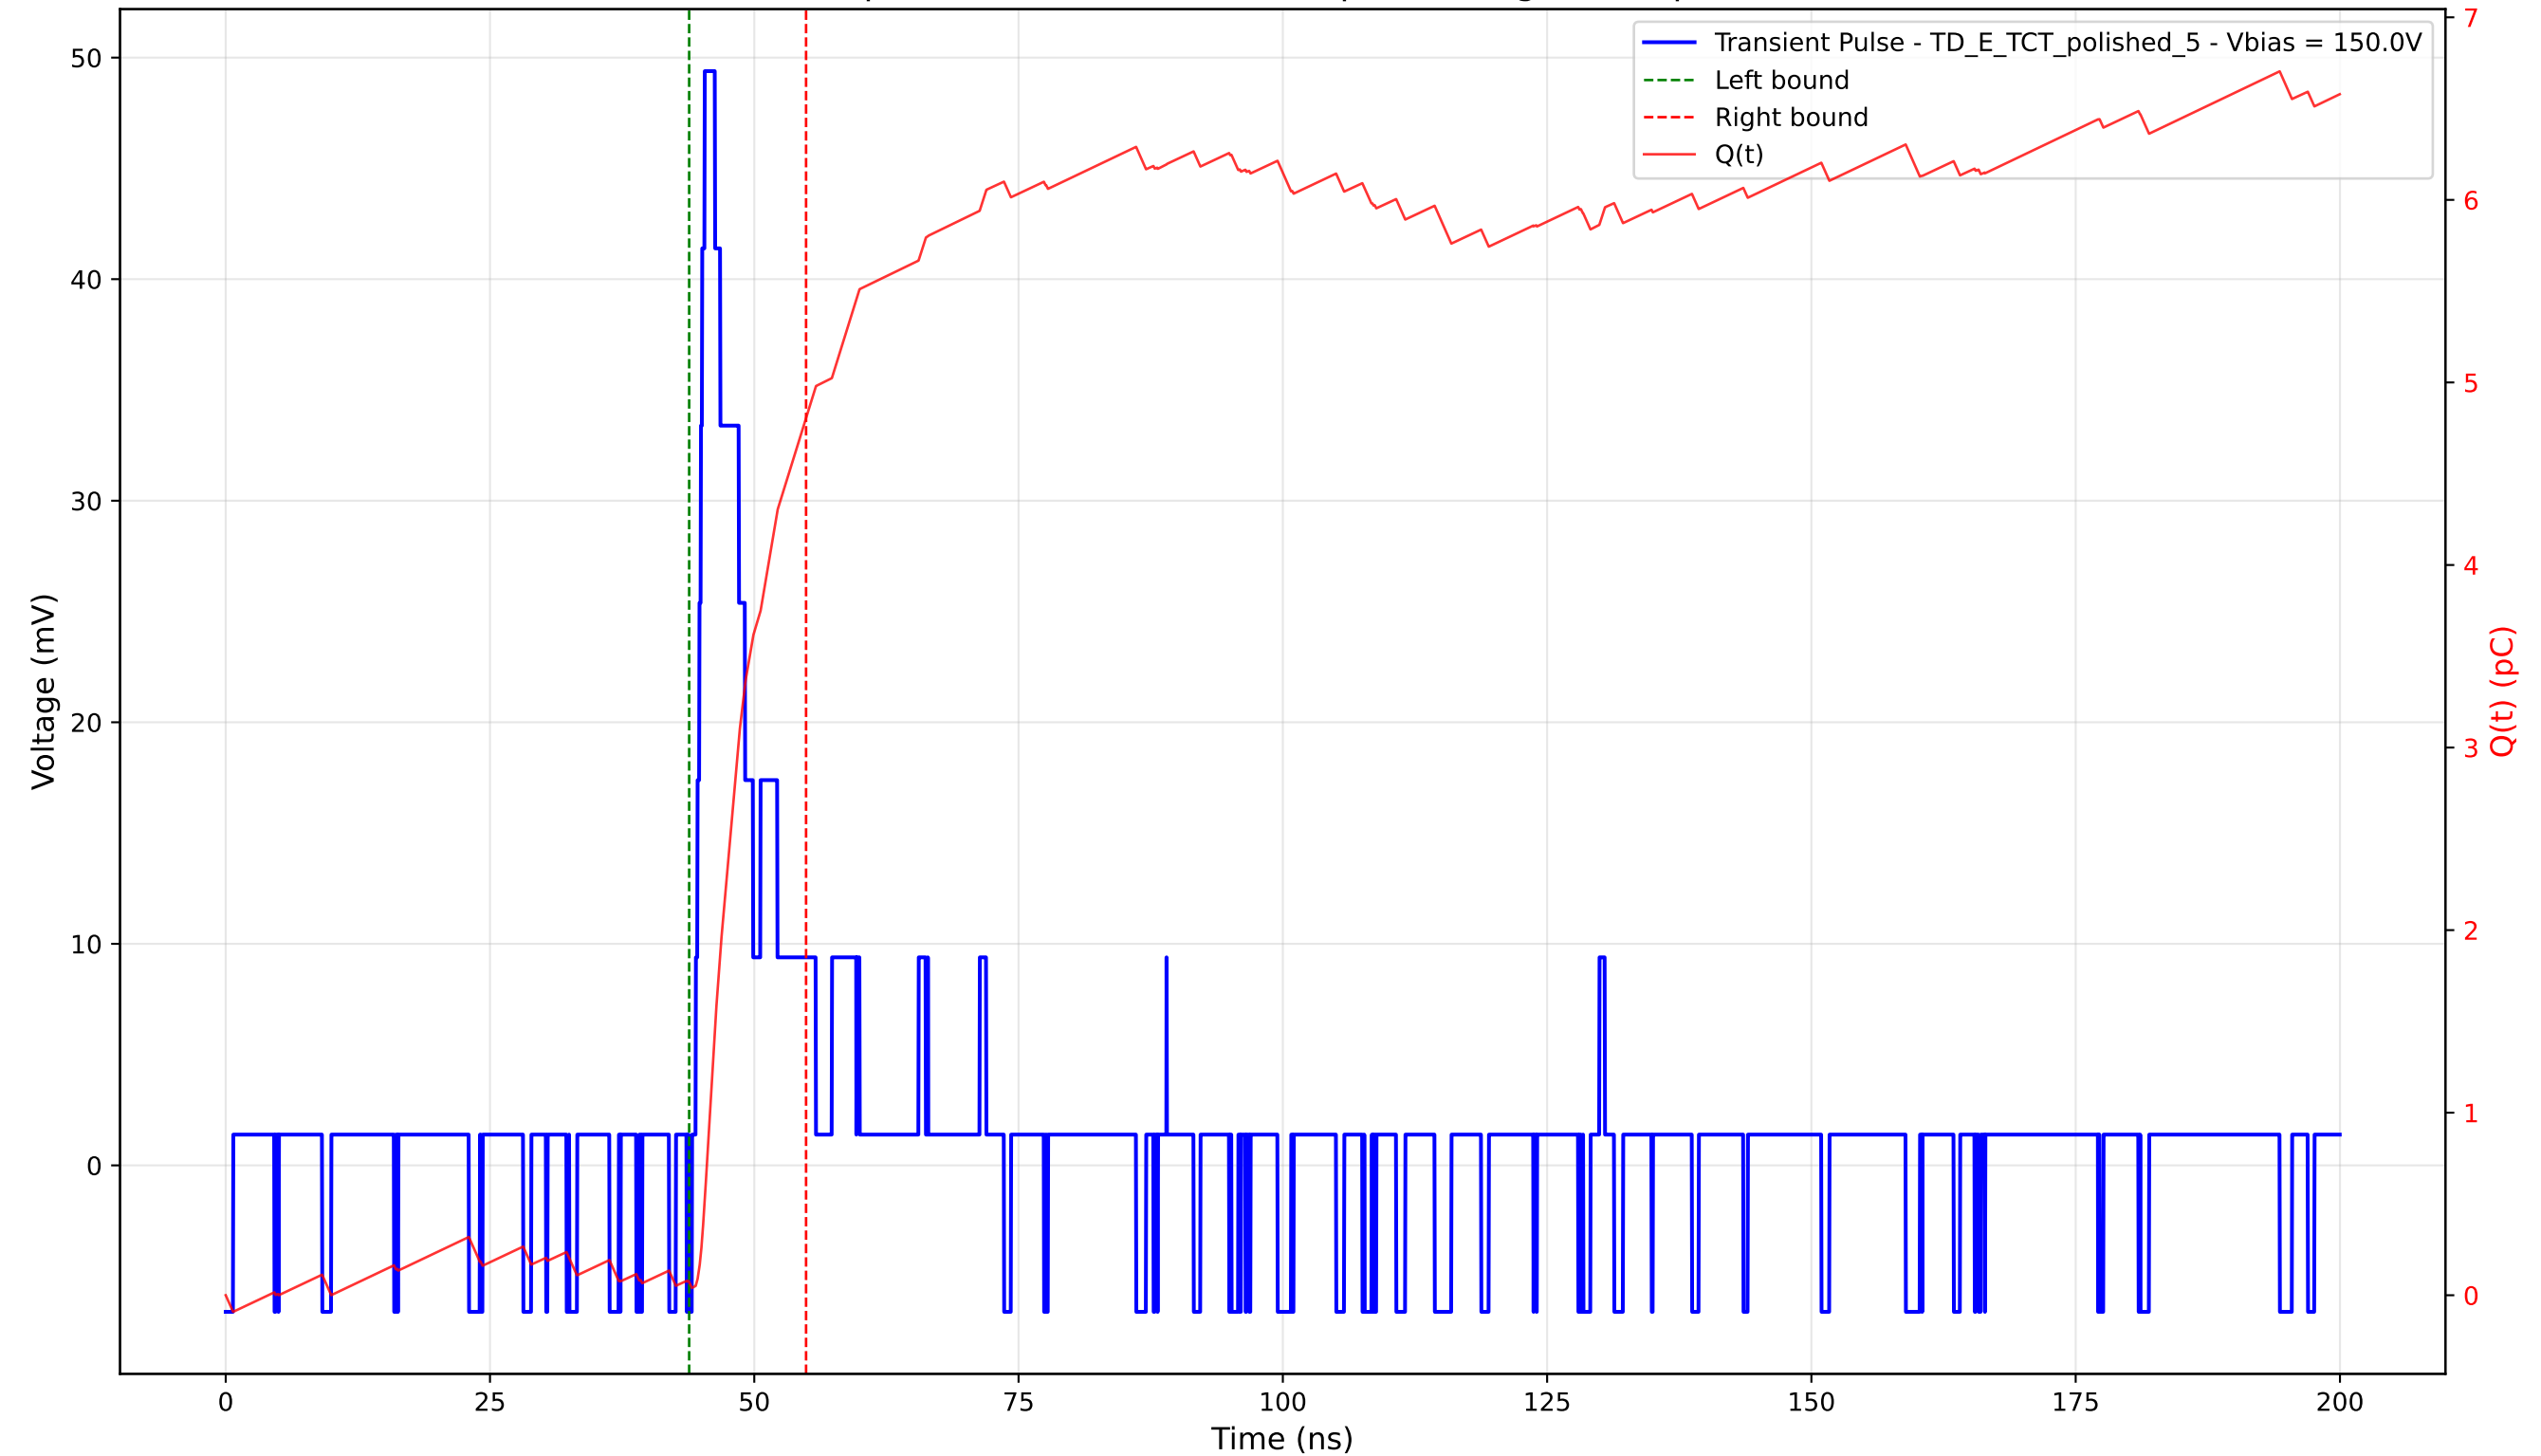


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 4.33 pC - Rise Time: 1.13 ns

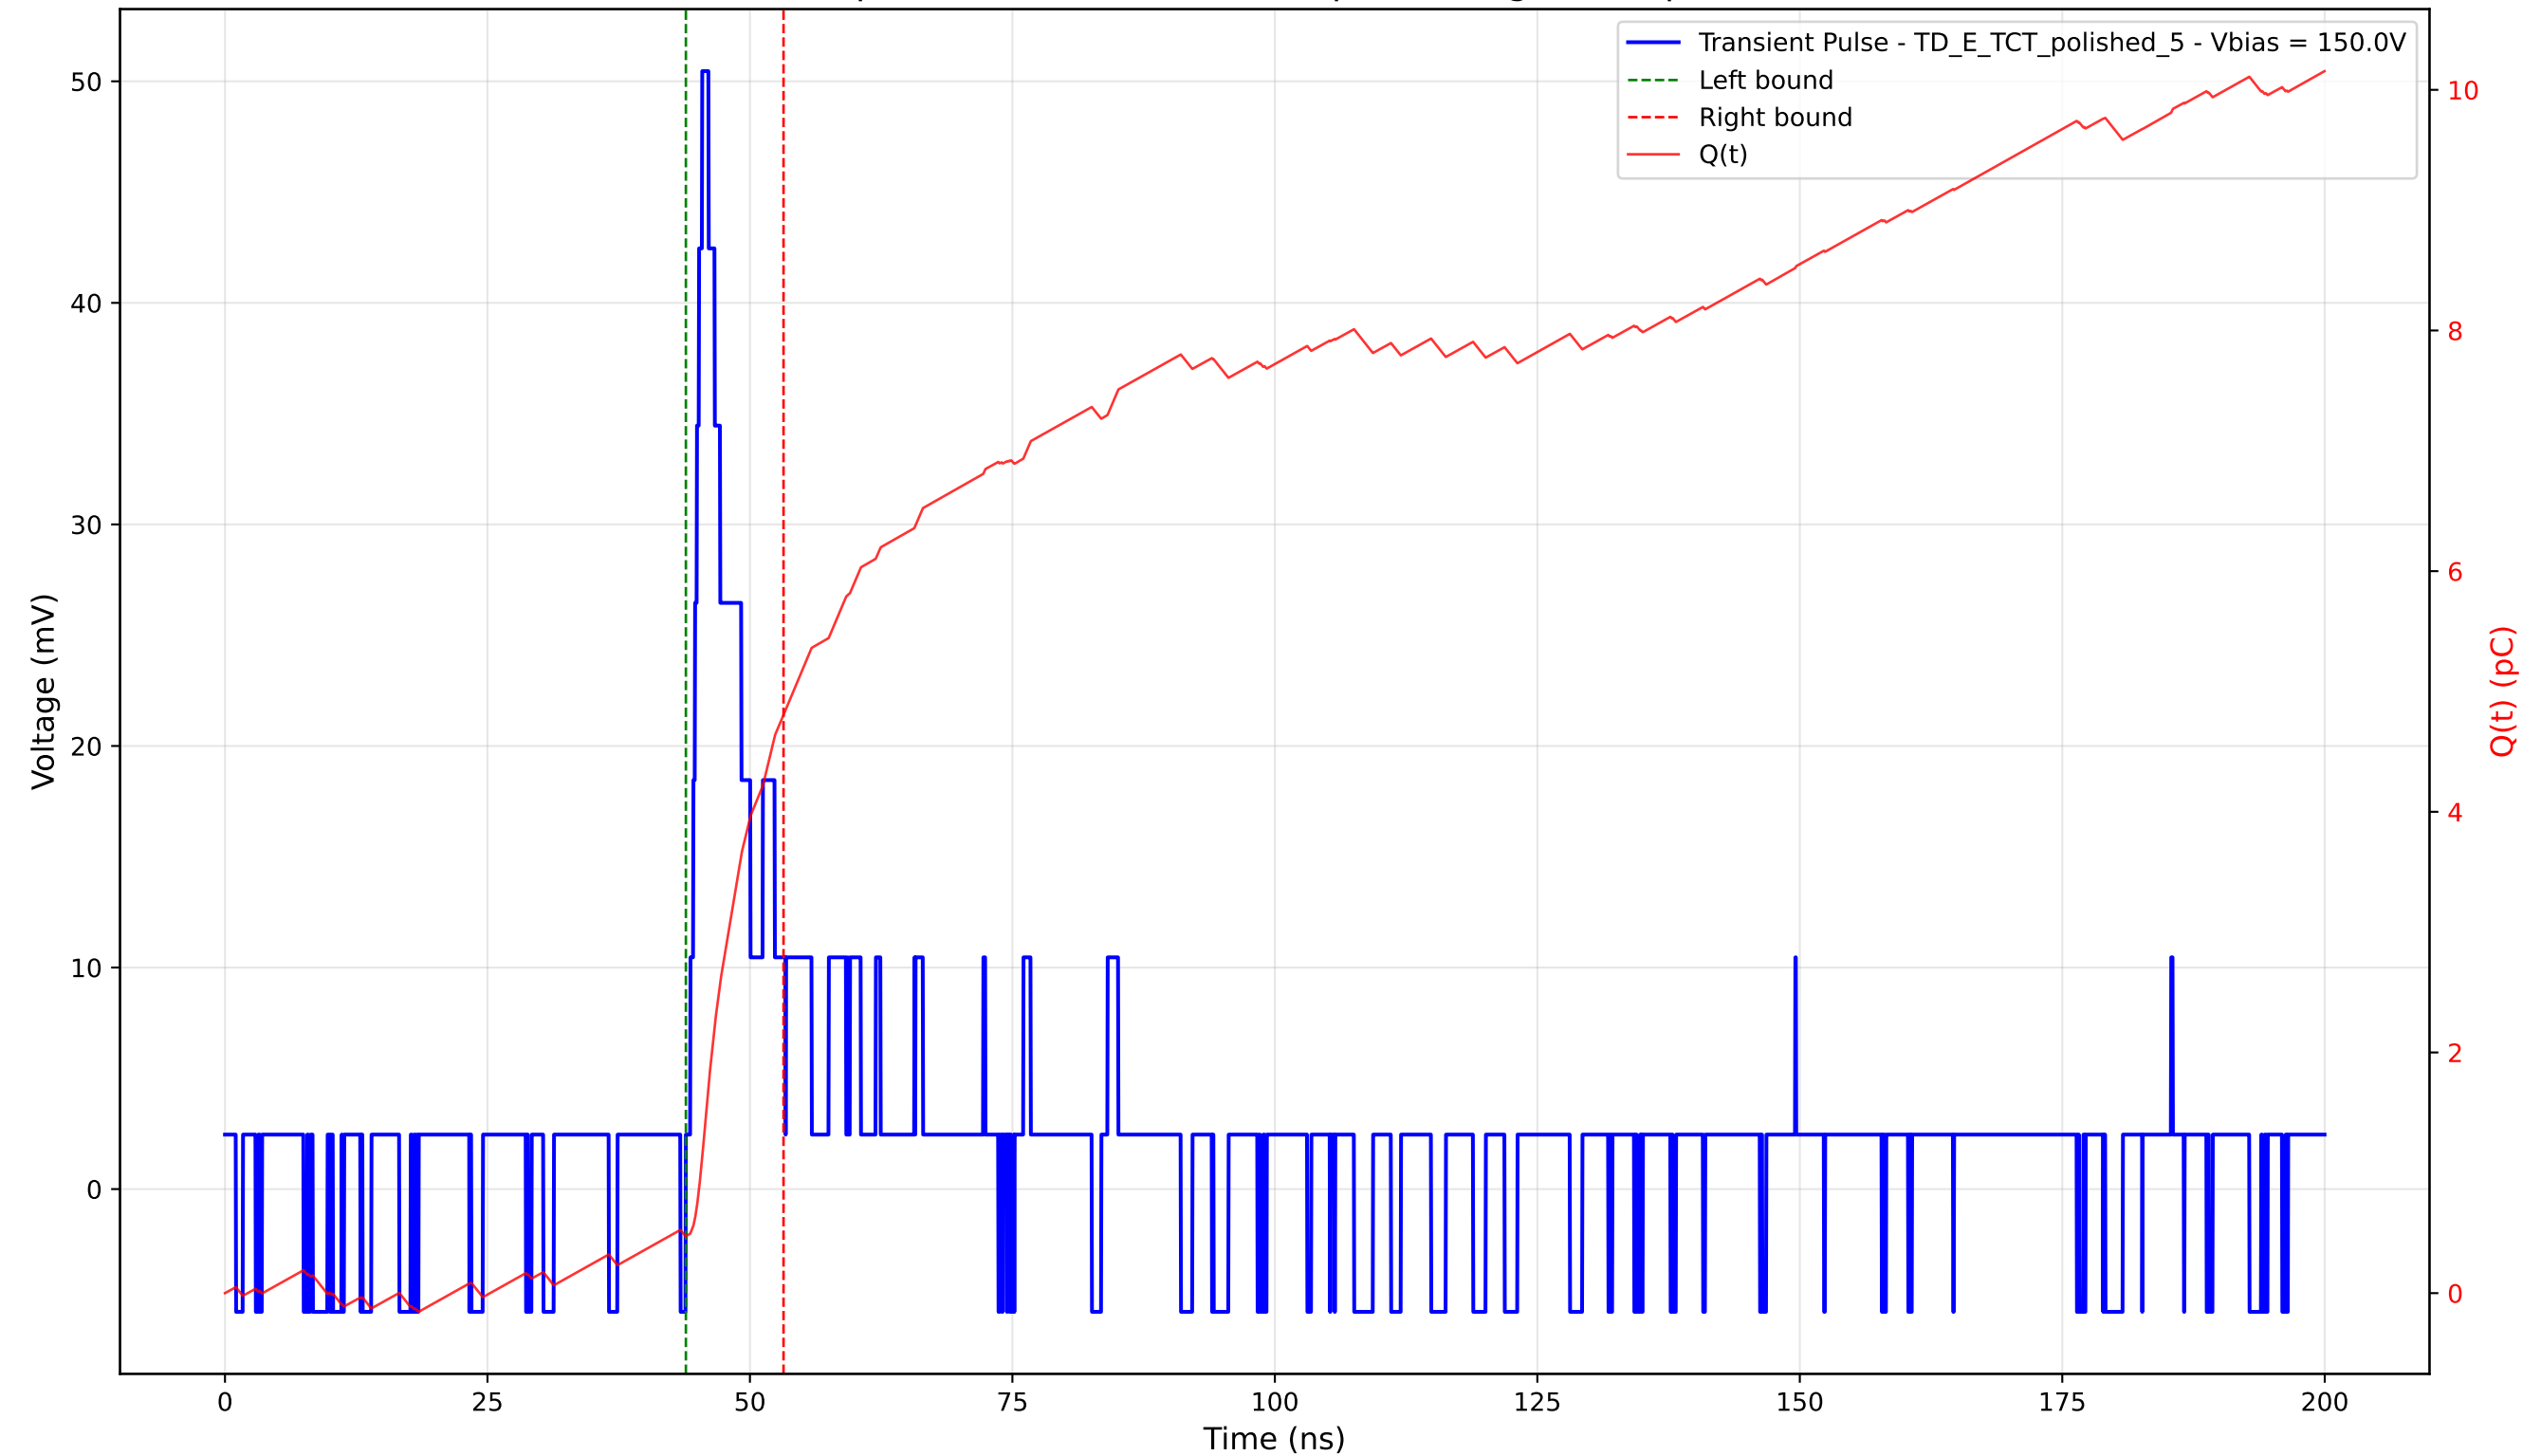


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 4.00 pC - Rise Time: 0.81 ns

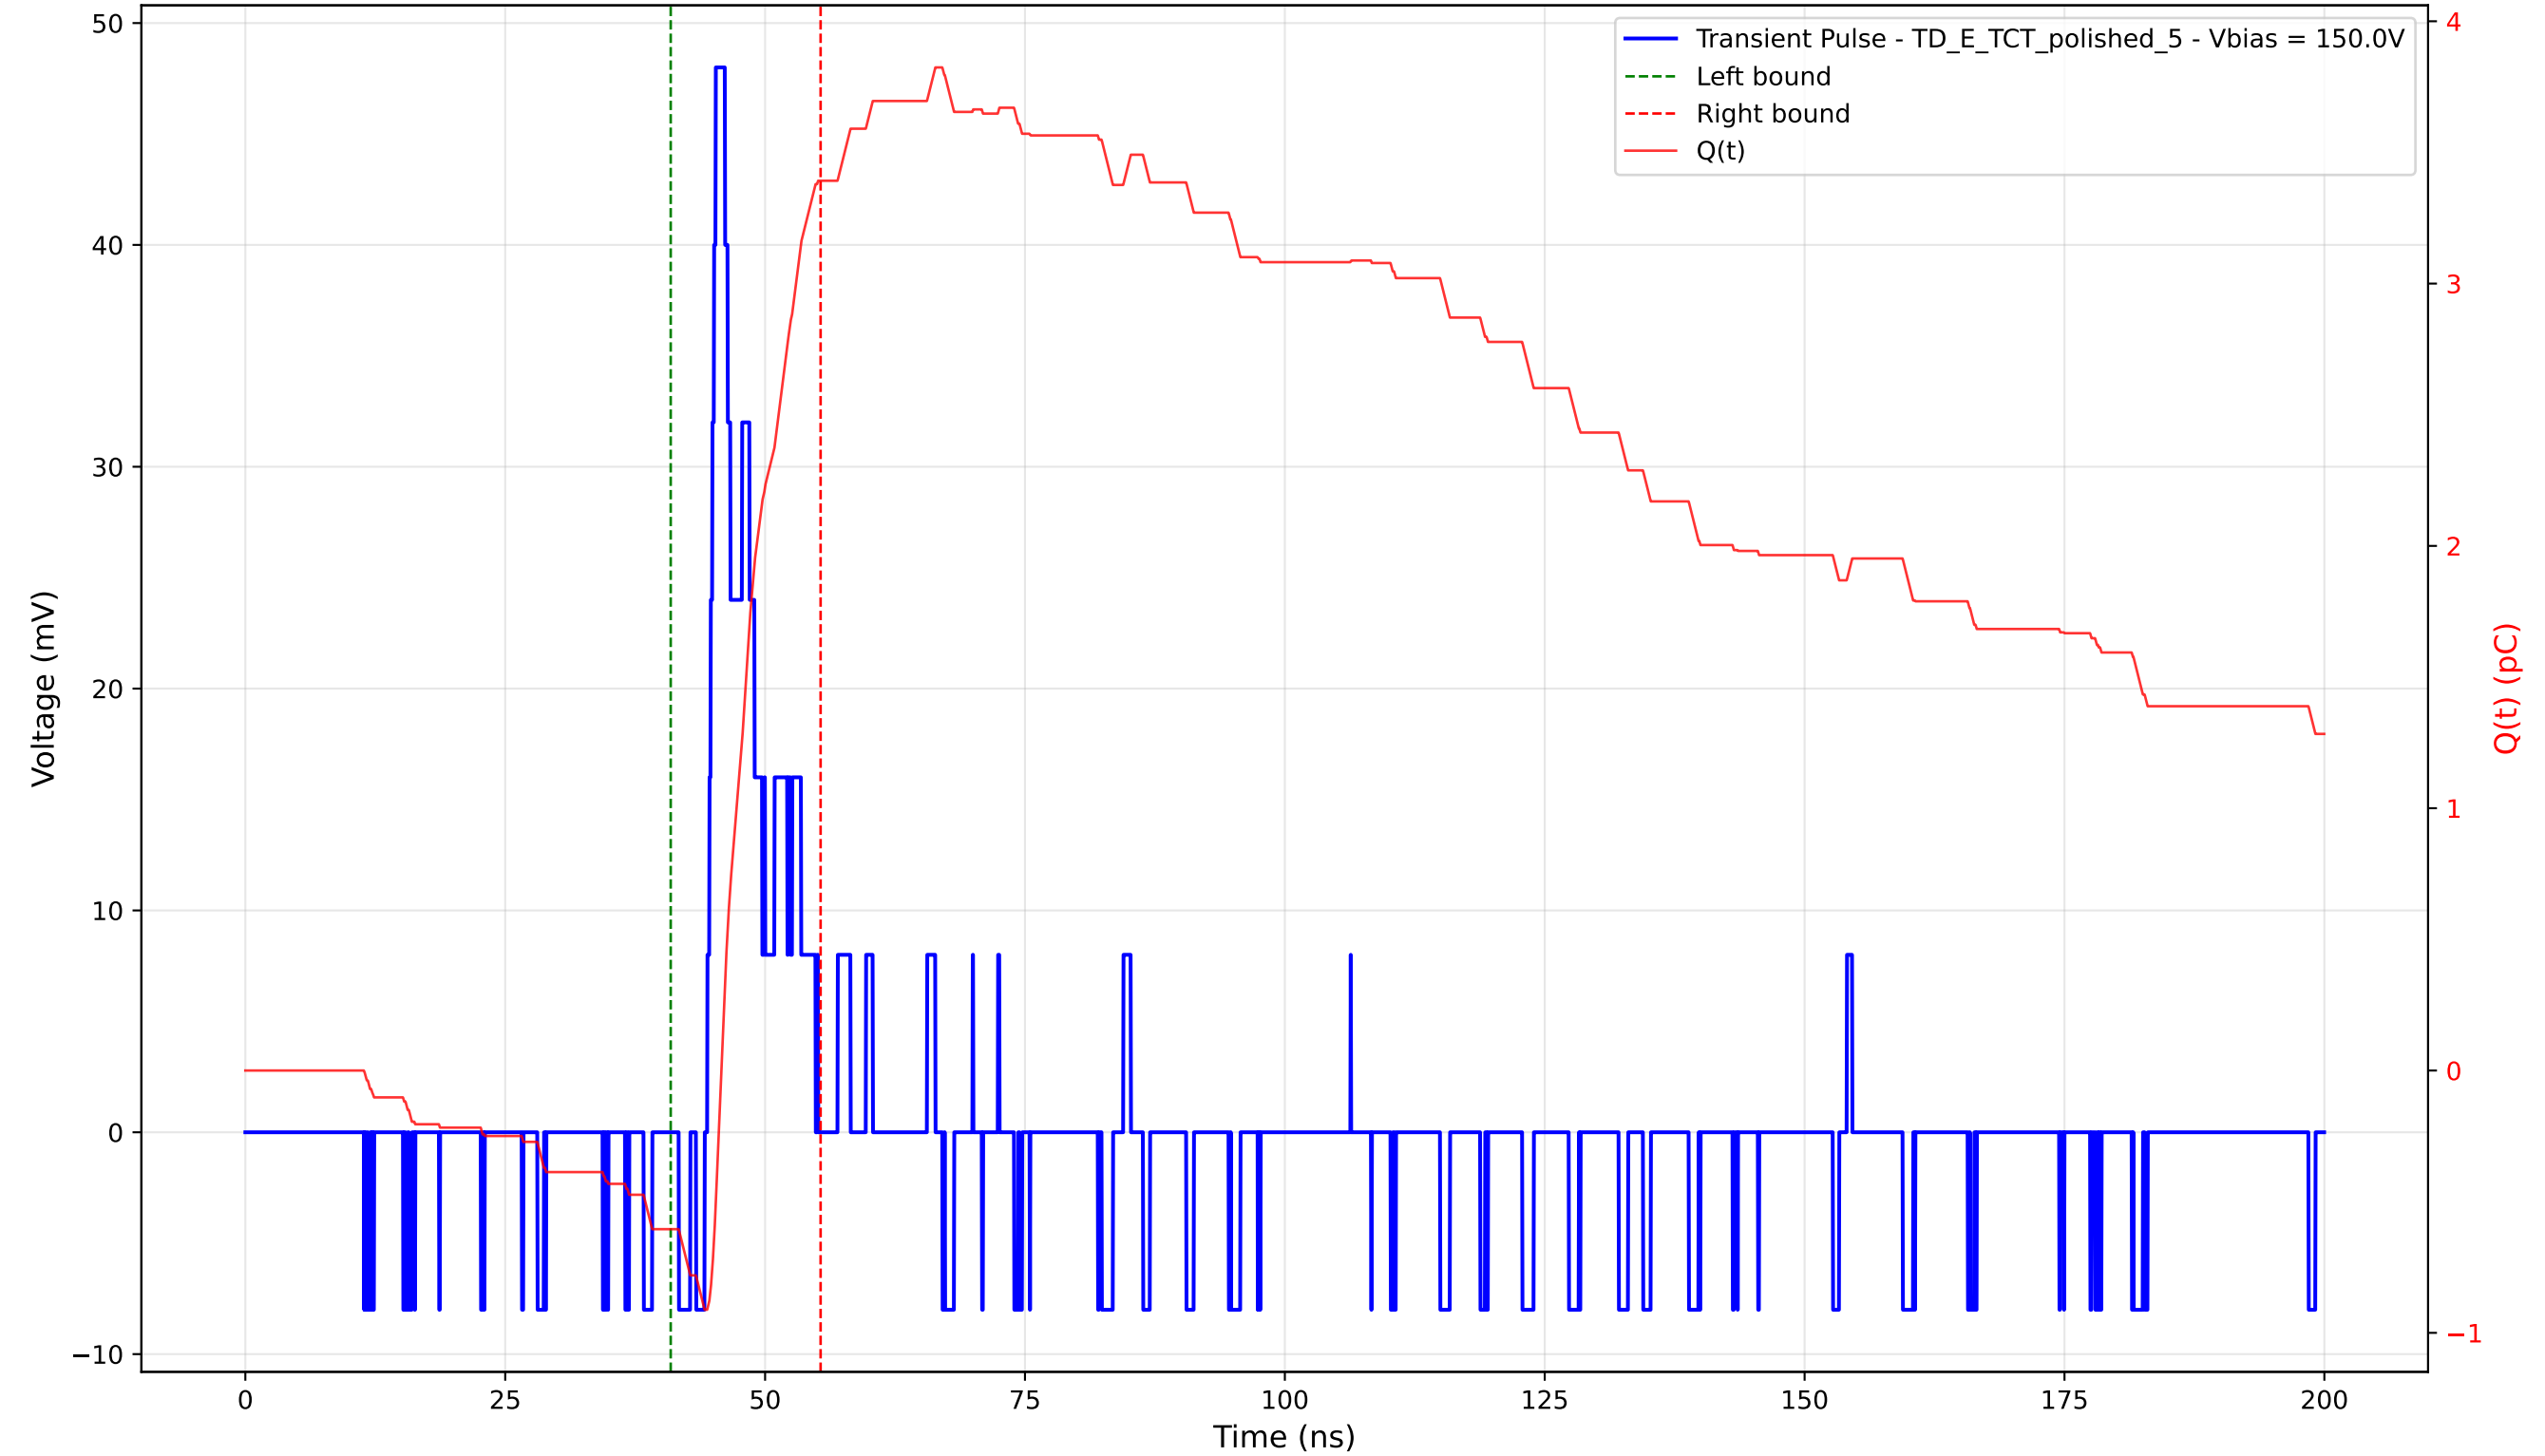


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 3.37 pC - Rise Time: 0.92 ns

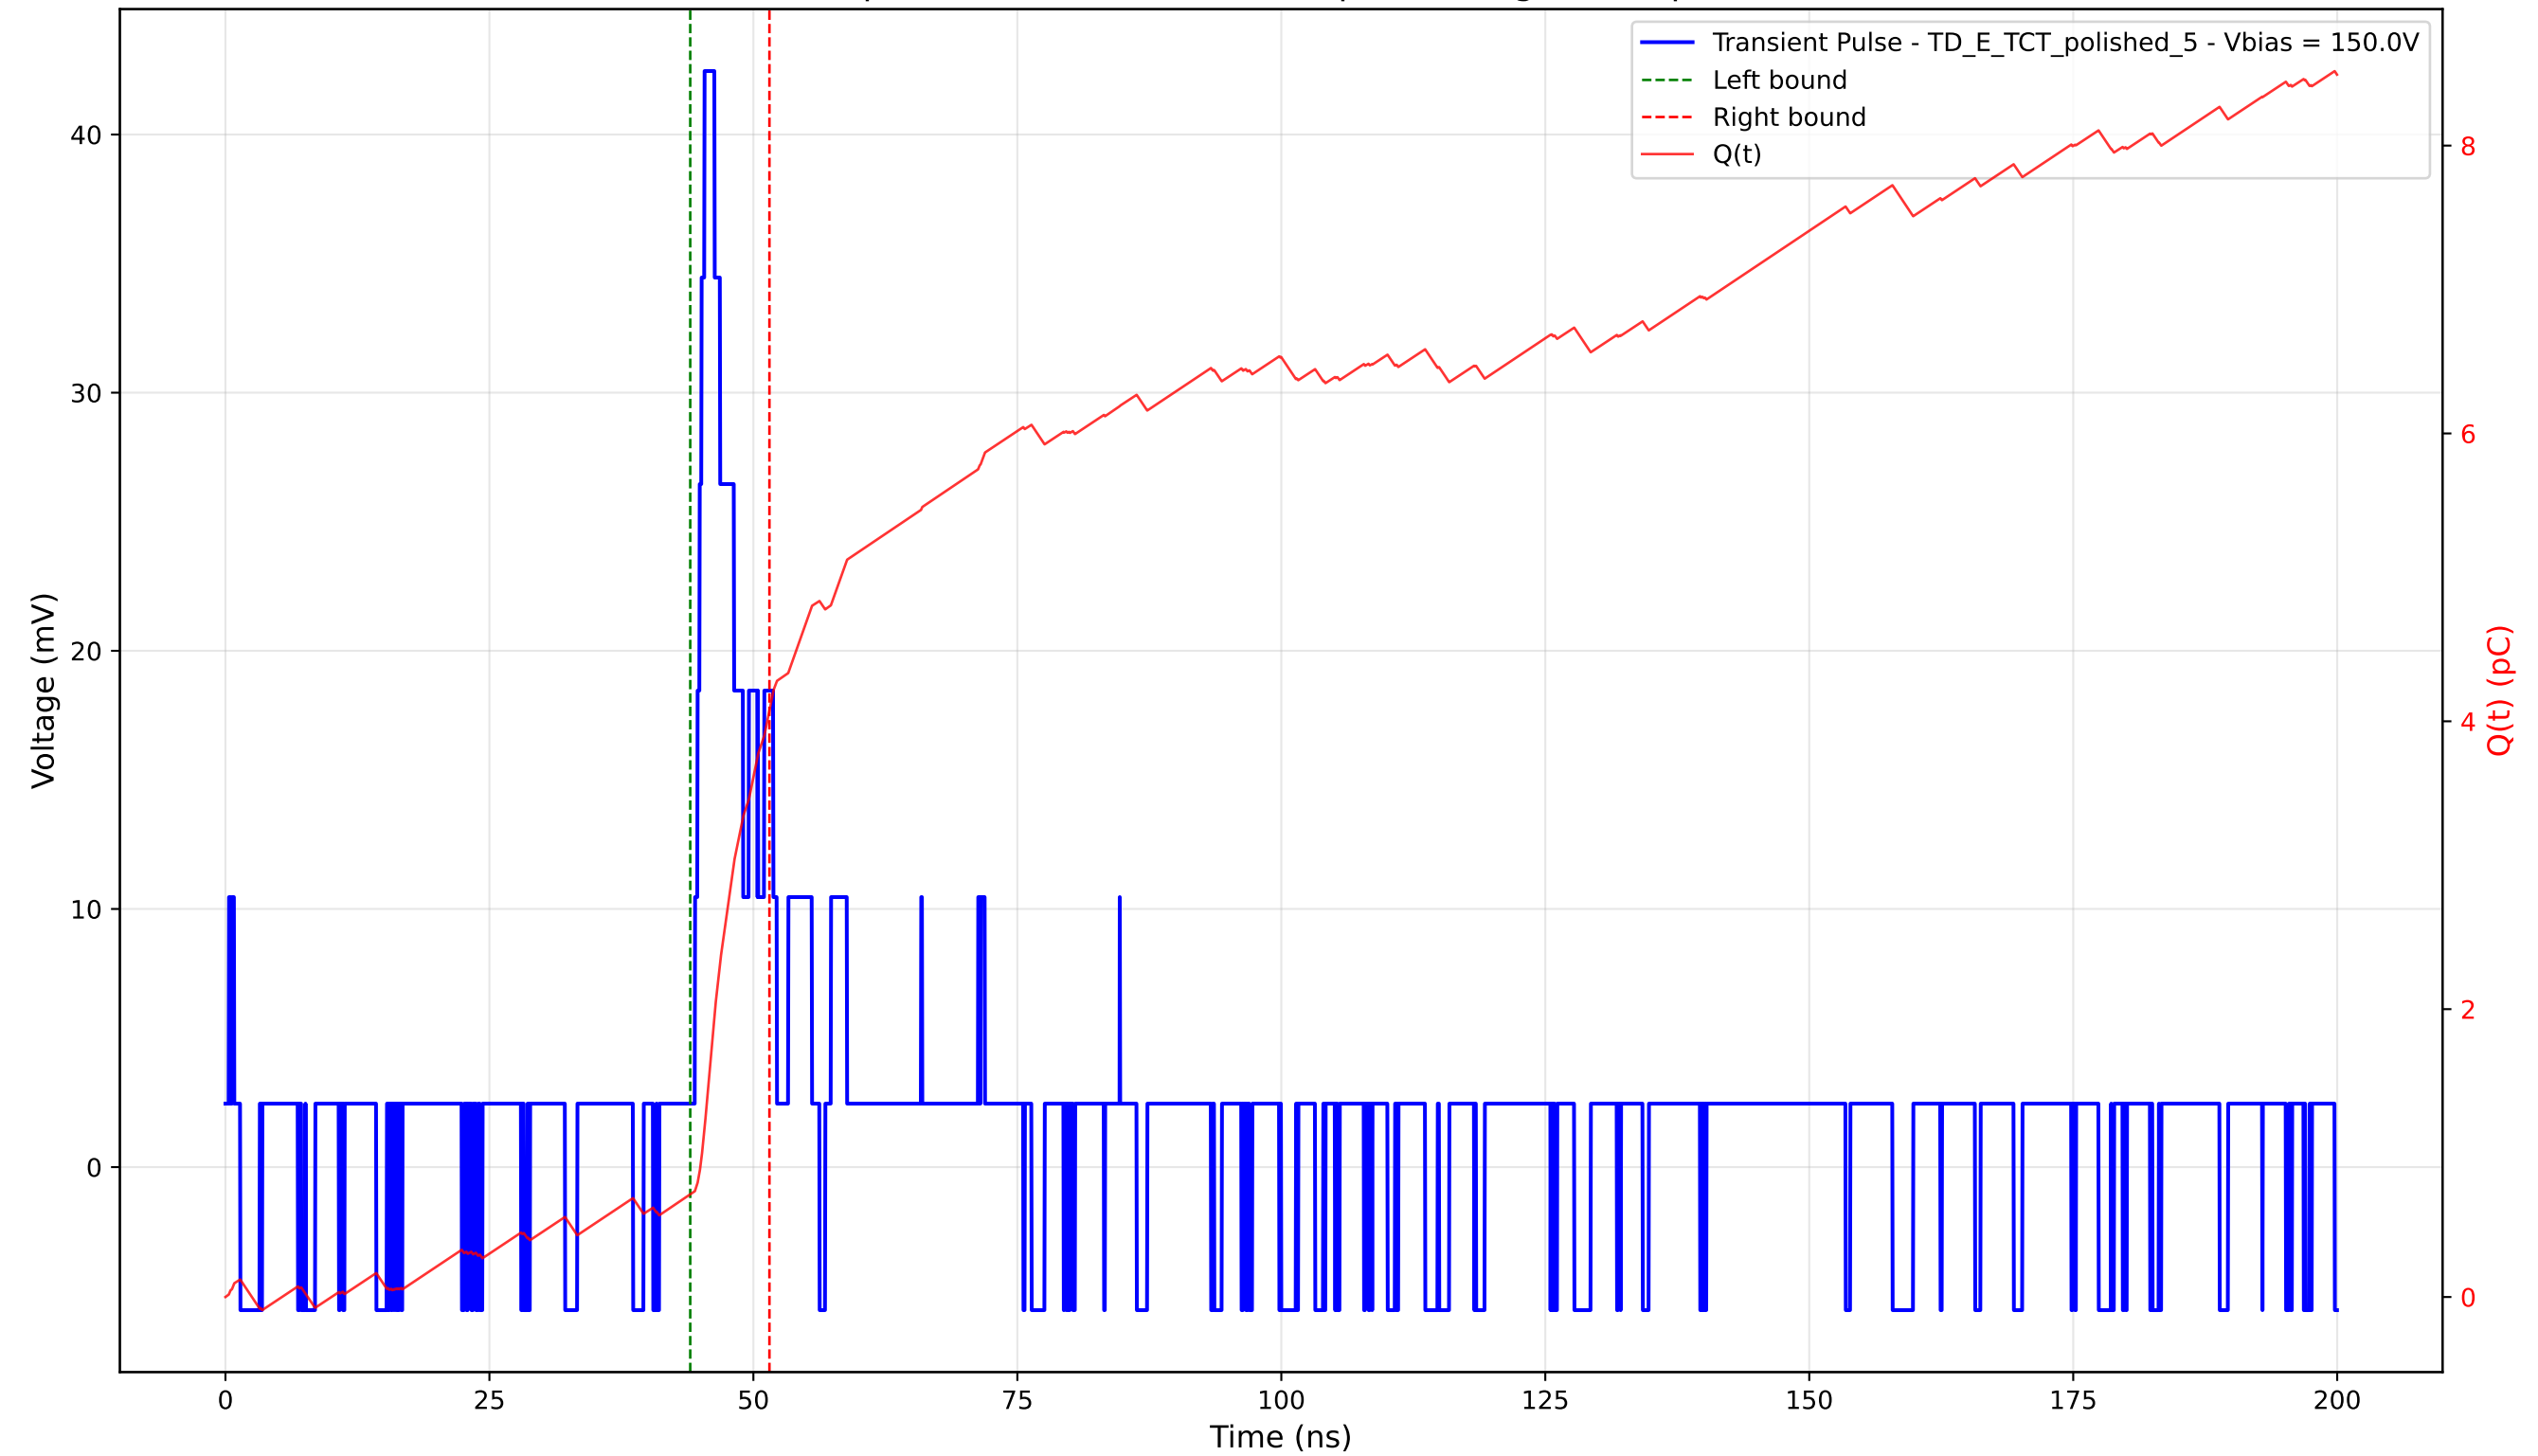


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 2.59 pC - Rise Time: 1.01 ns

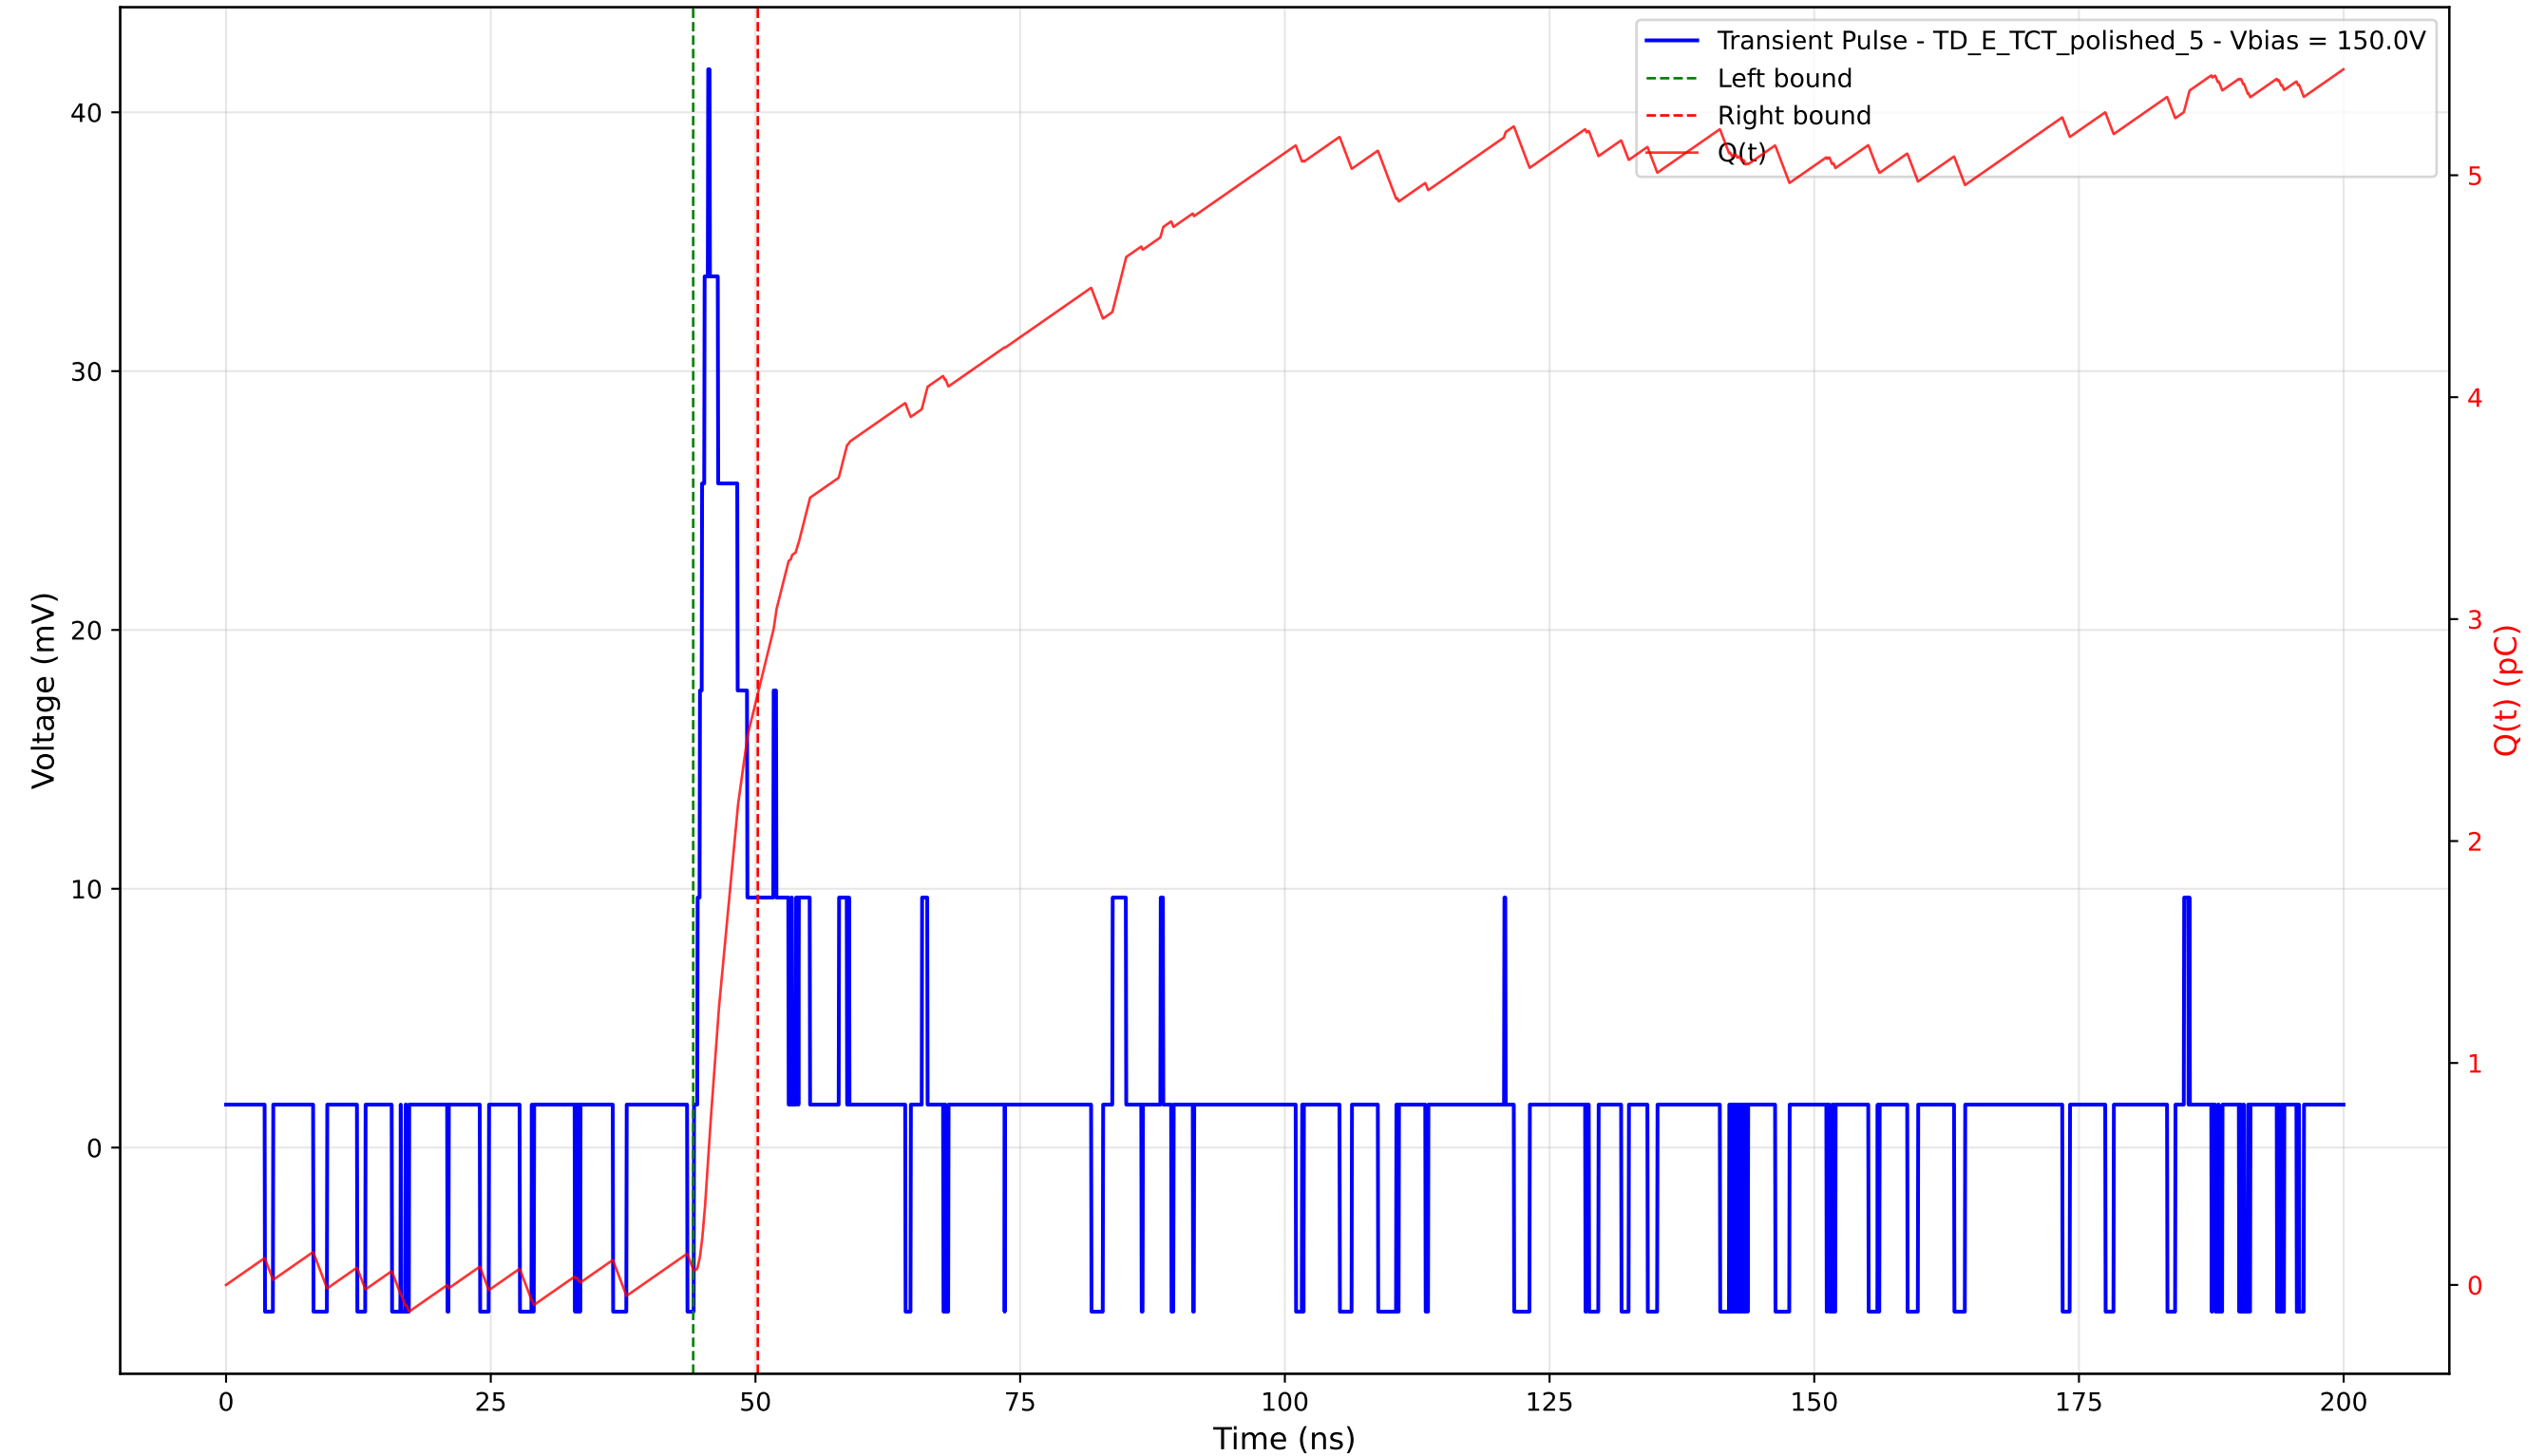


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 1.54 pC - Rise Time: 1.04 ns

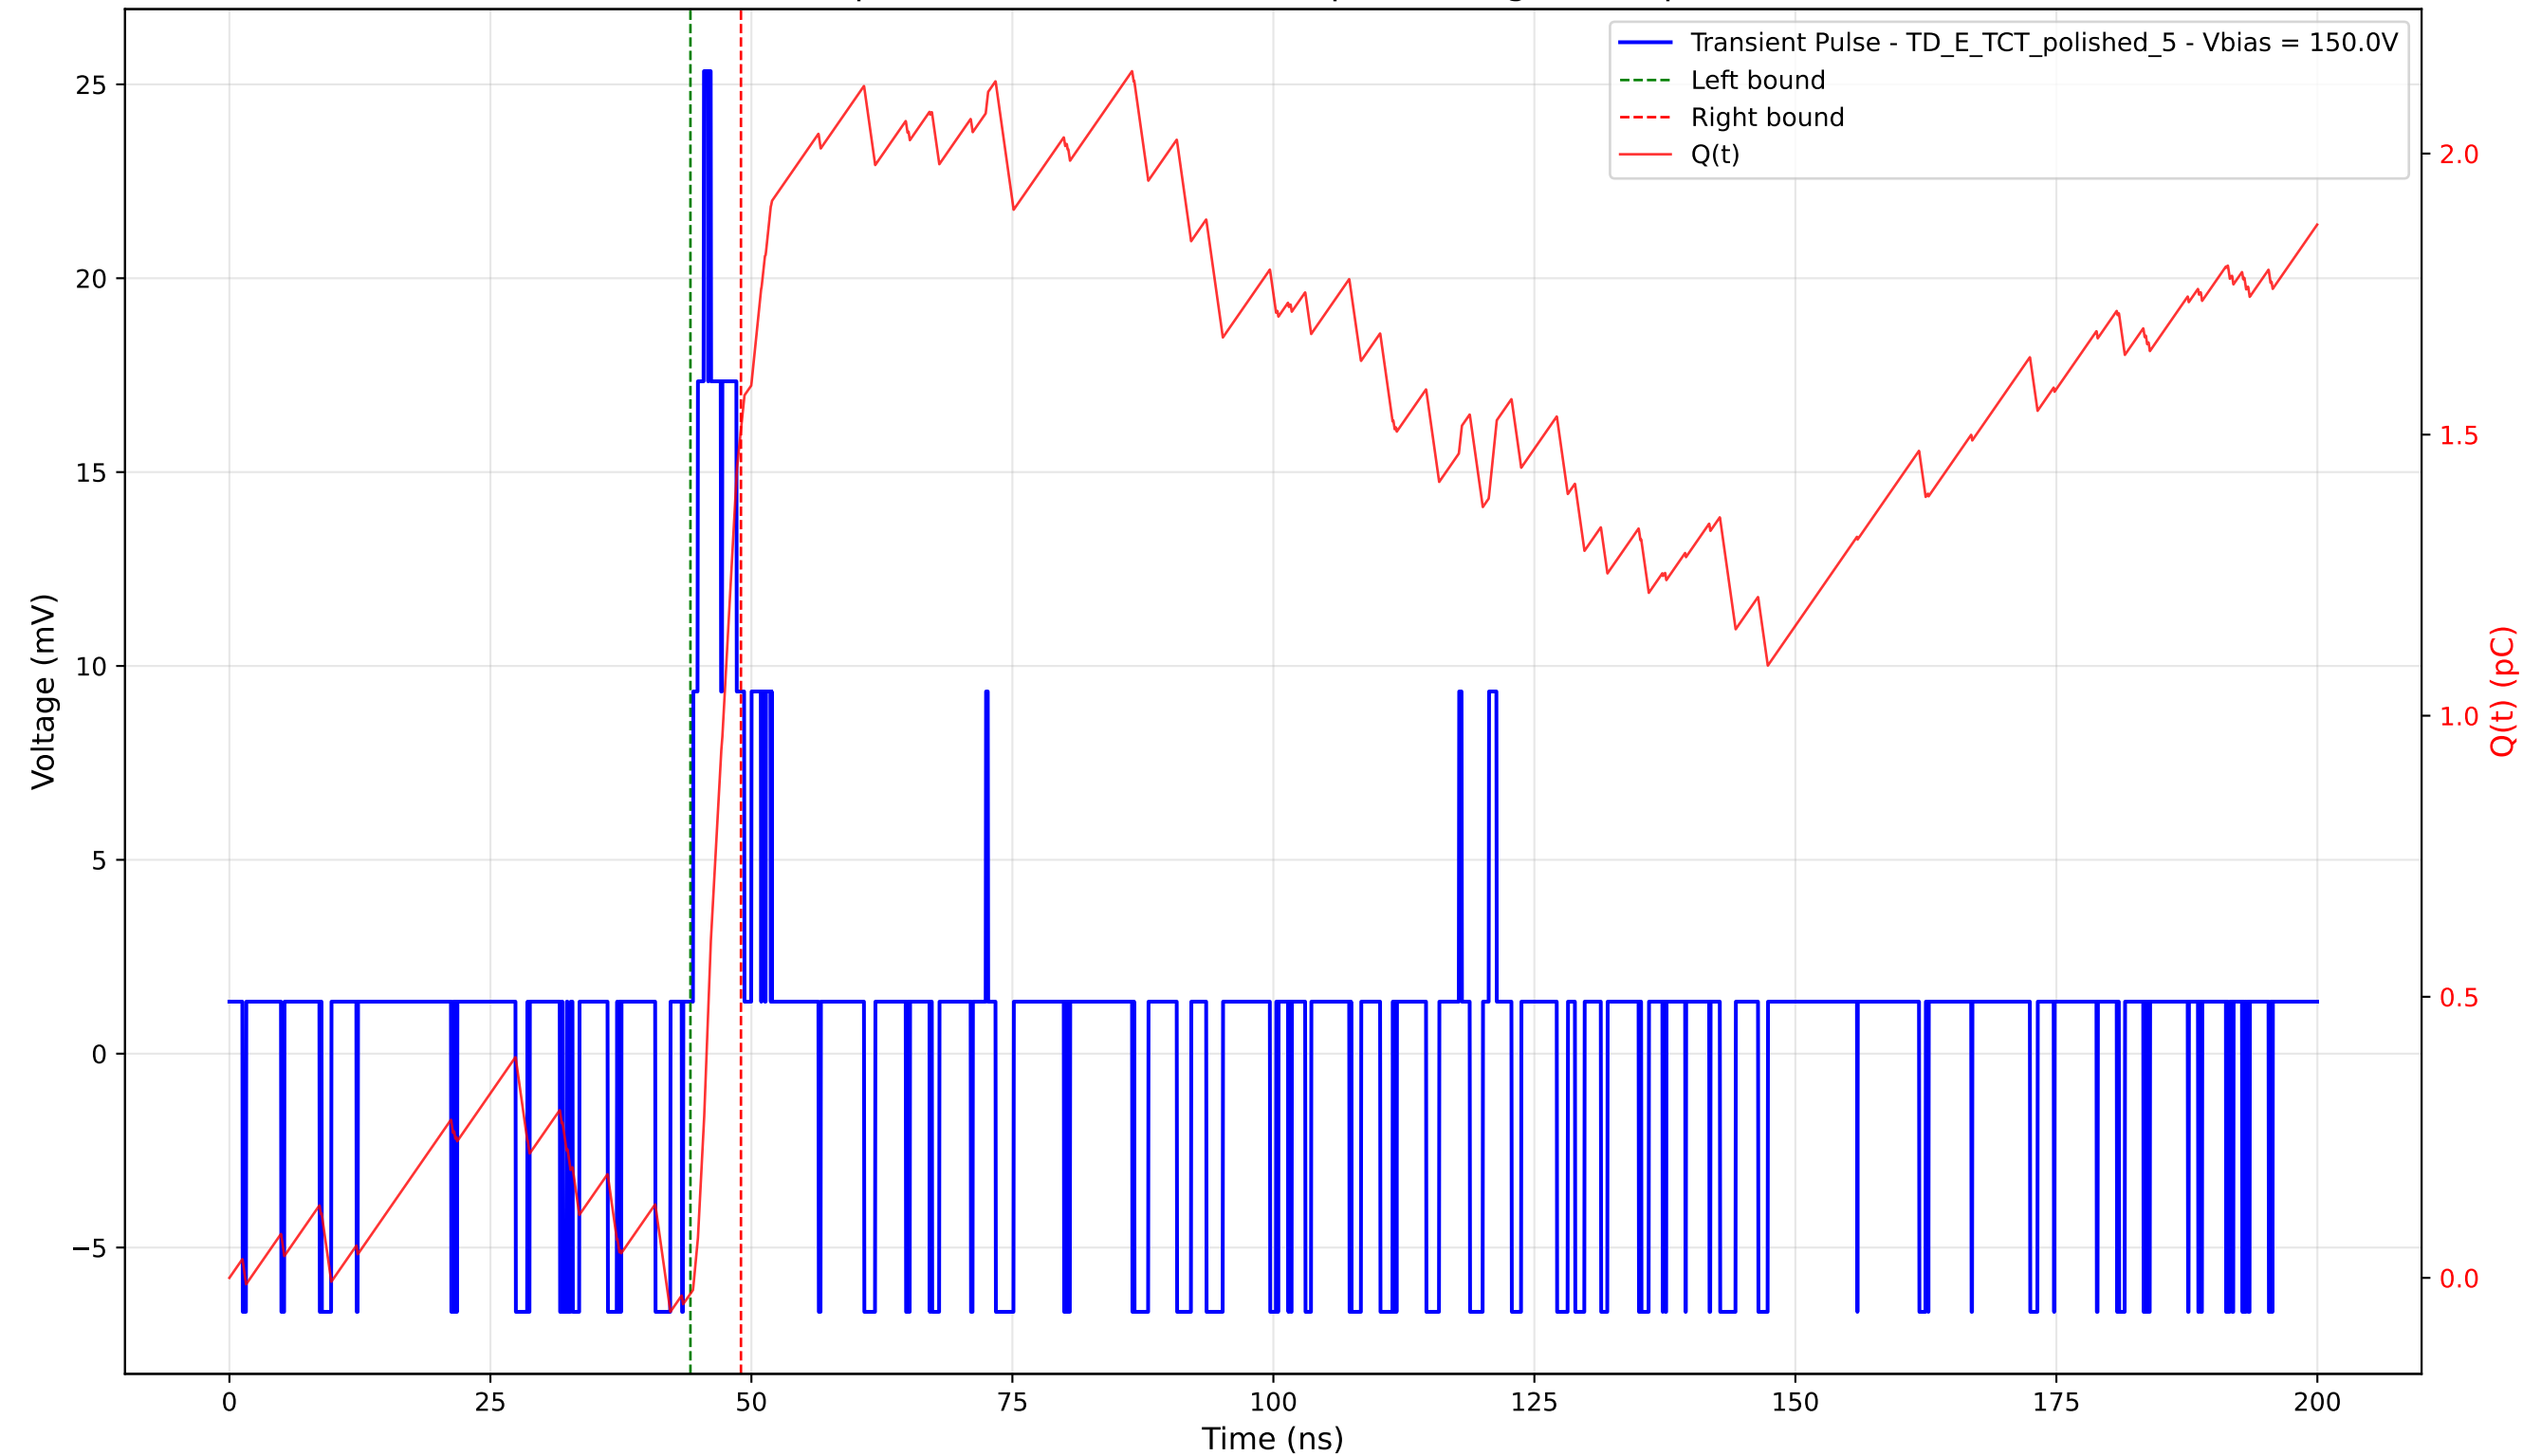

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.96 pC - Rise Time: 0.00 ns (N/A)

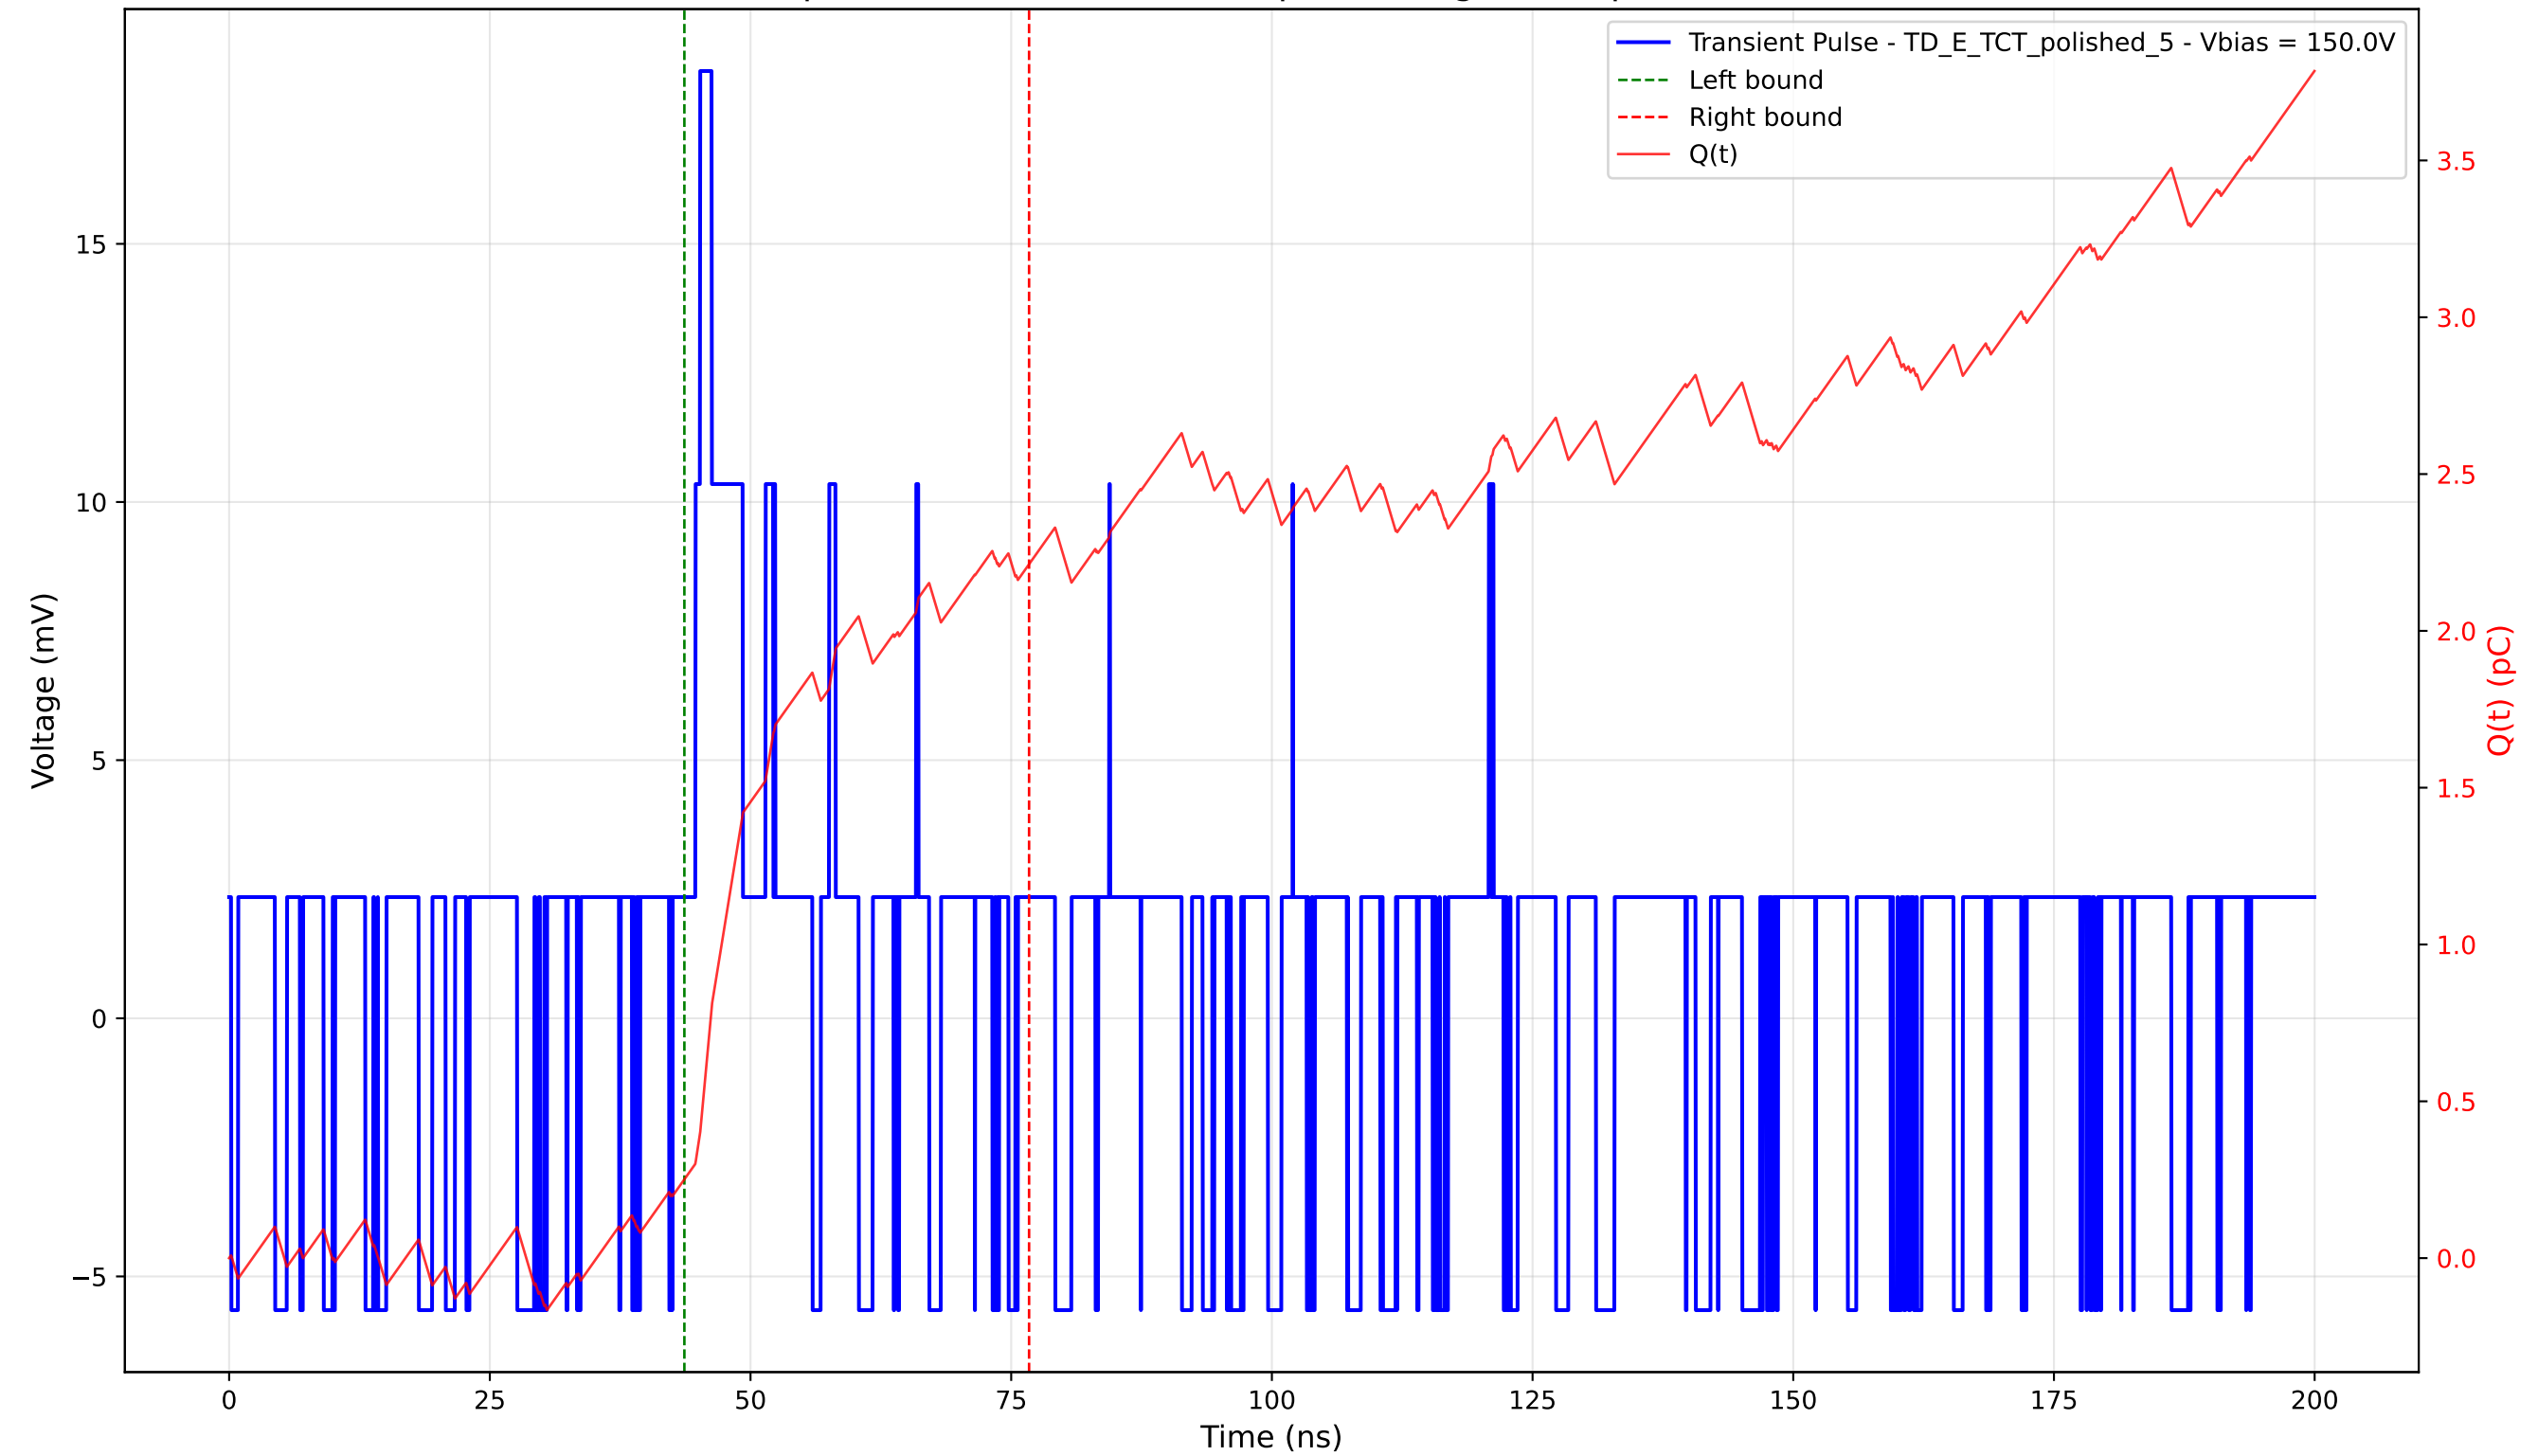

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 1.57 pC - Rise Time: 0.00 ns (N/A)

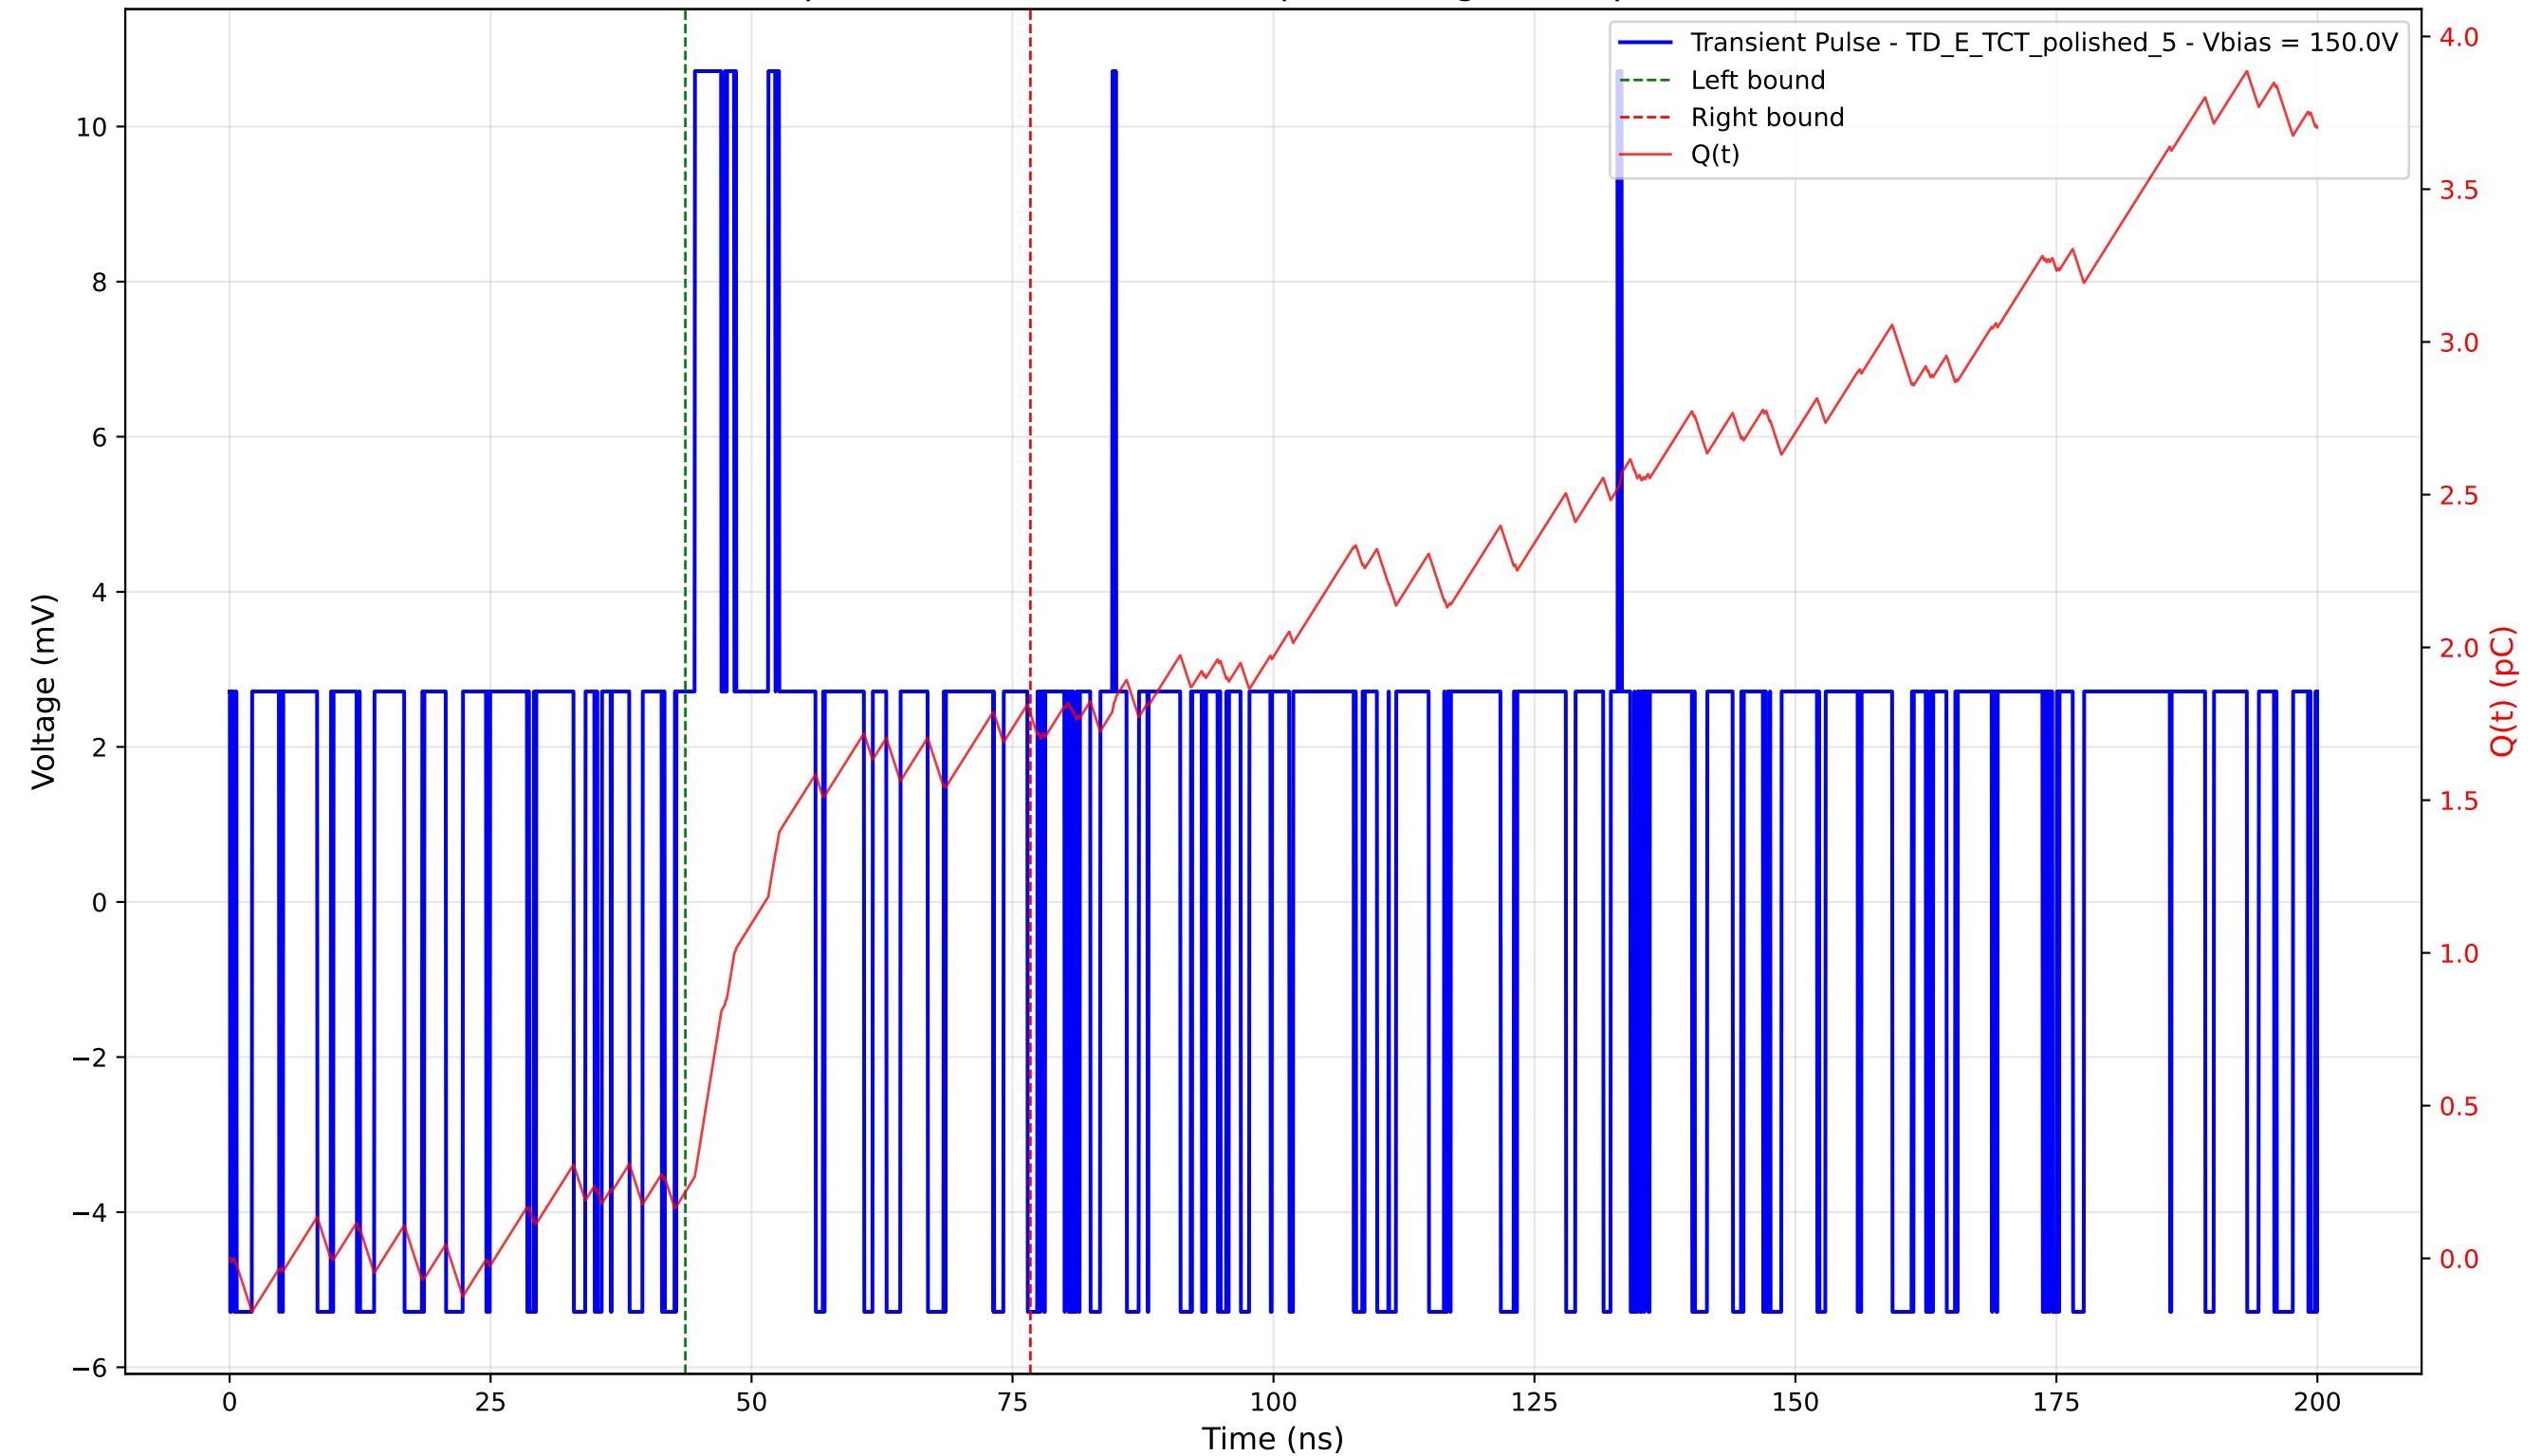

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.80 pC - Rise Time: 0.00 ns (N/A)

