


TCT Run 007 Summary

Parameter	Value
Run	Run007
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	350.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\350V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

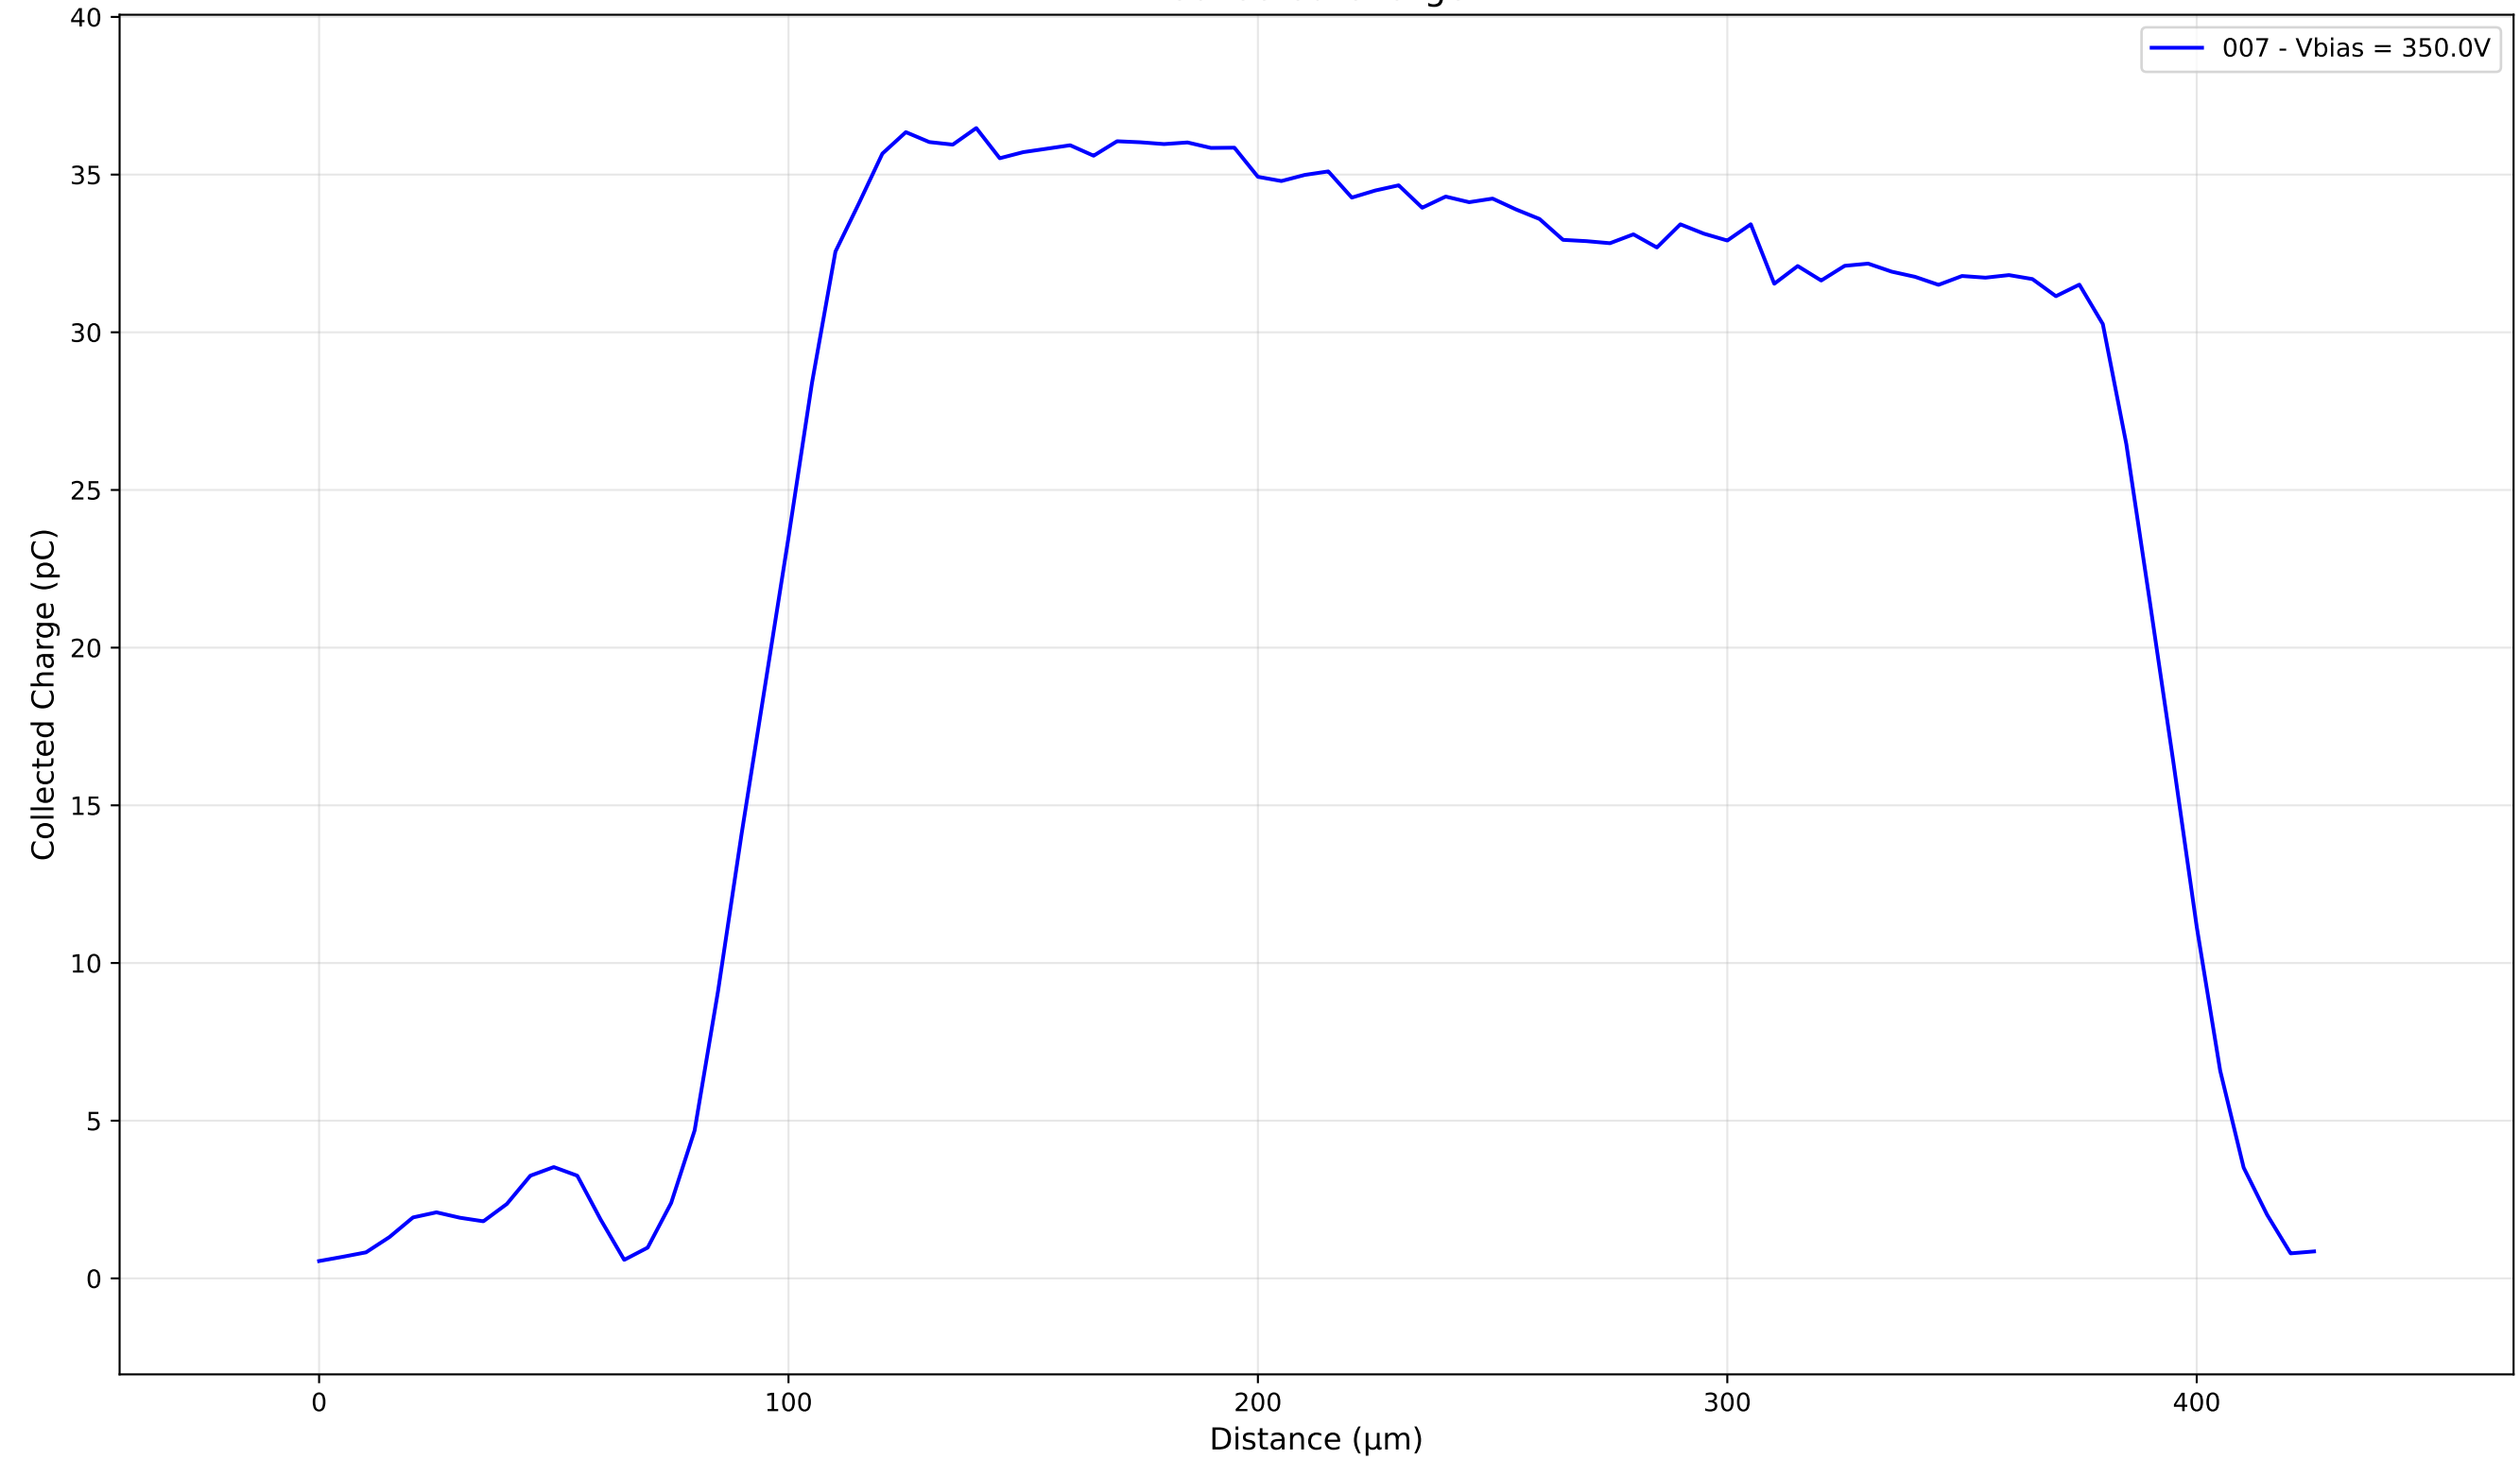

Collected Charge

007 - Vbias = 350.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

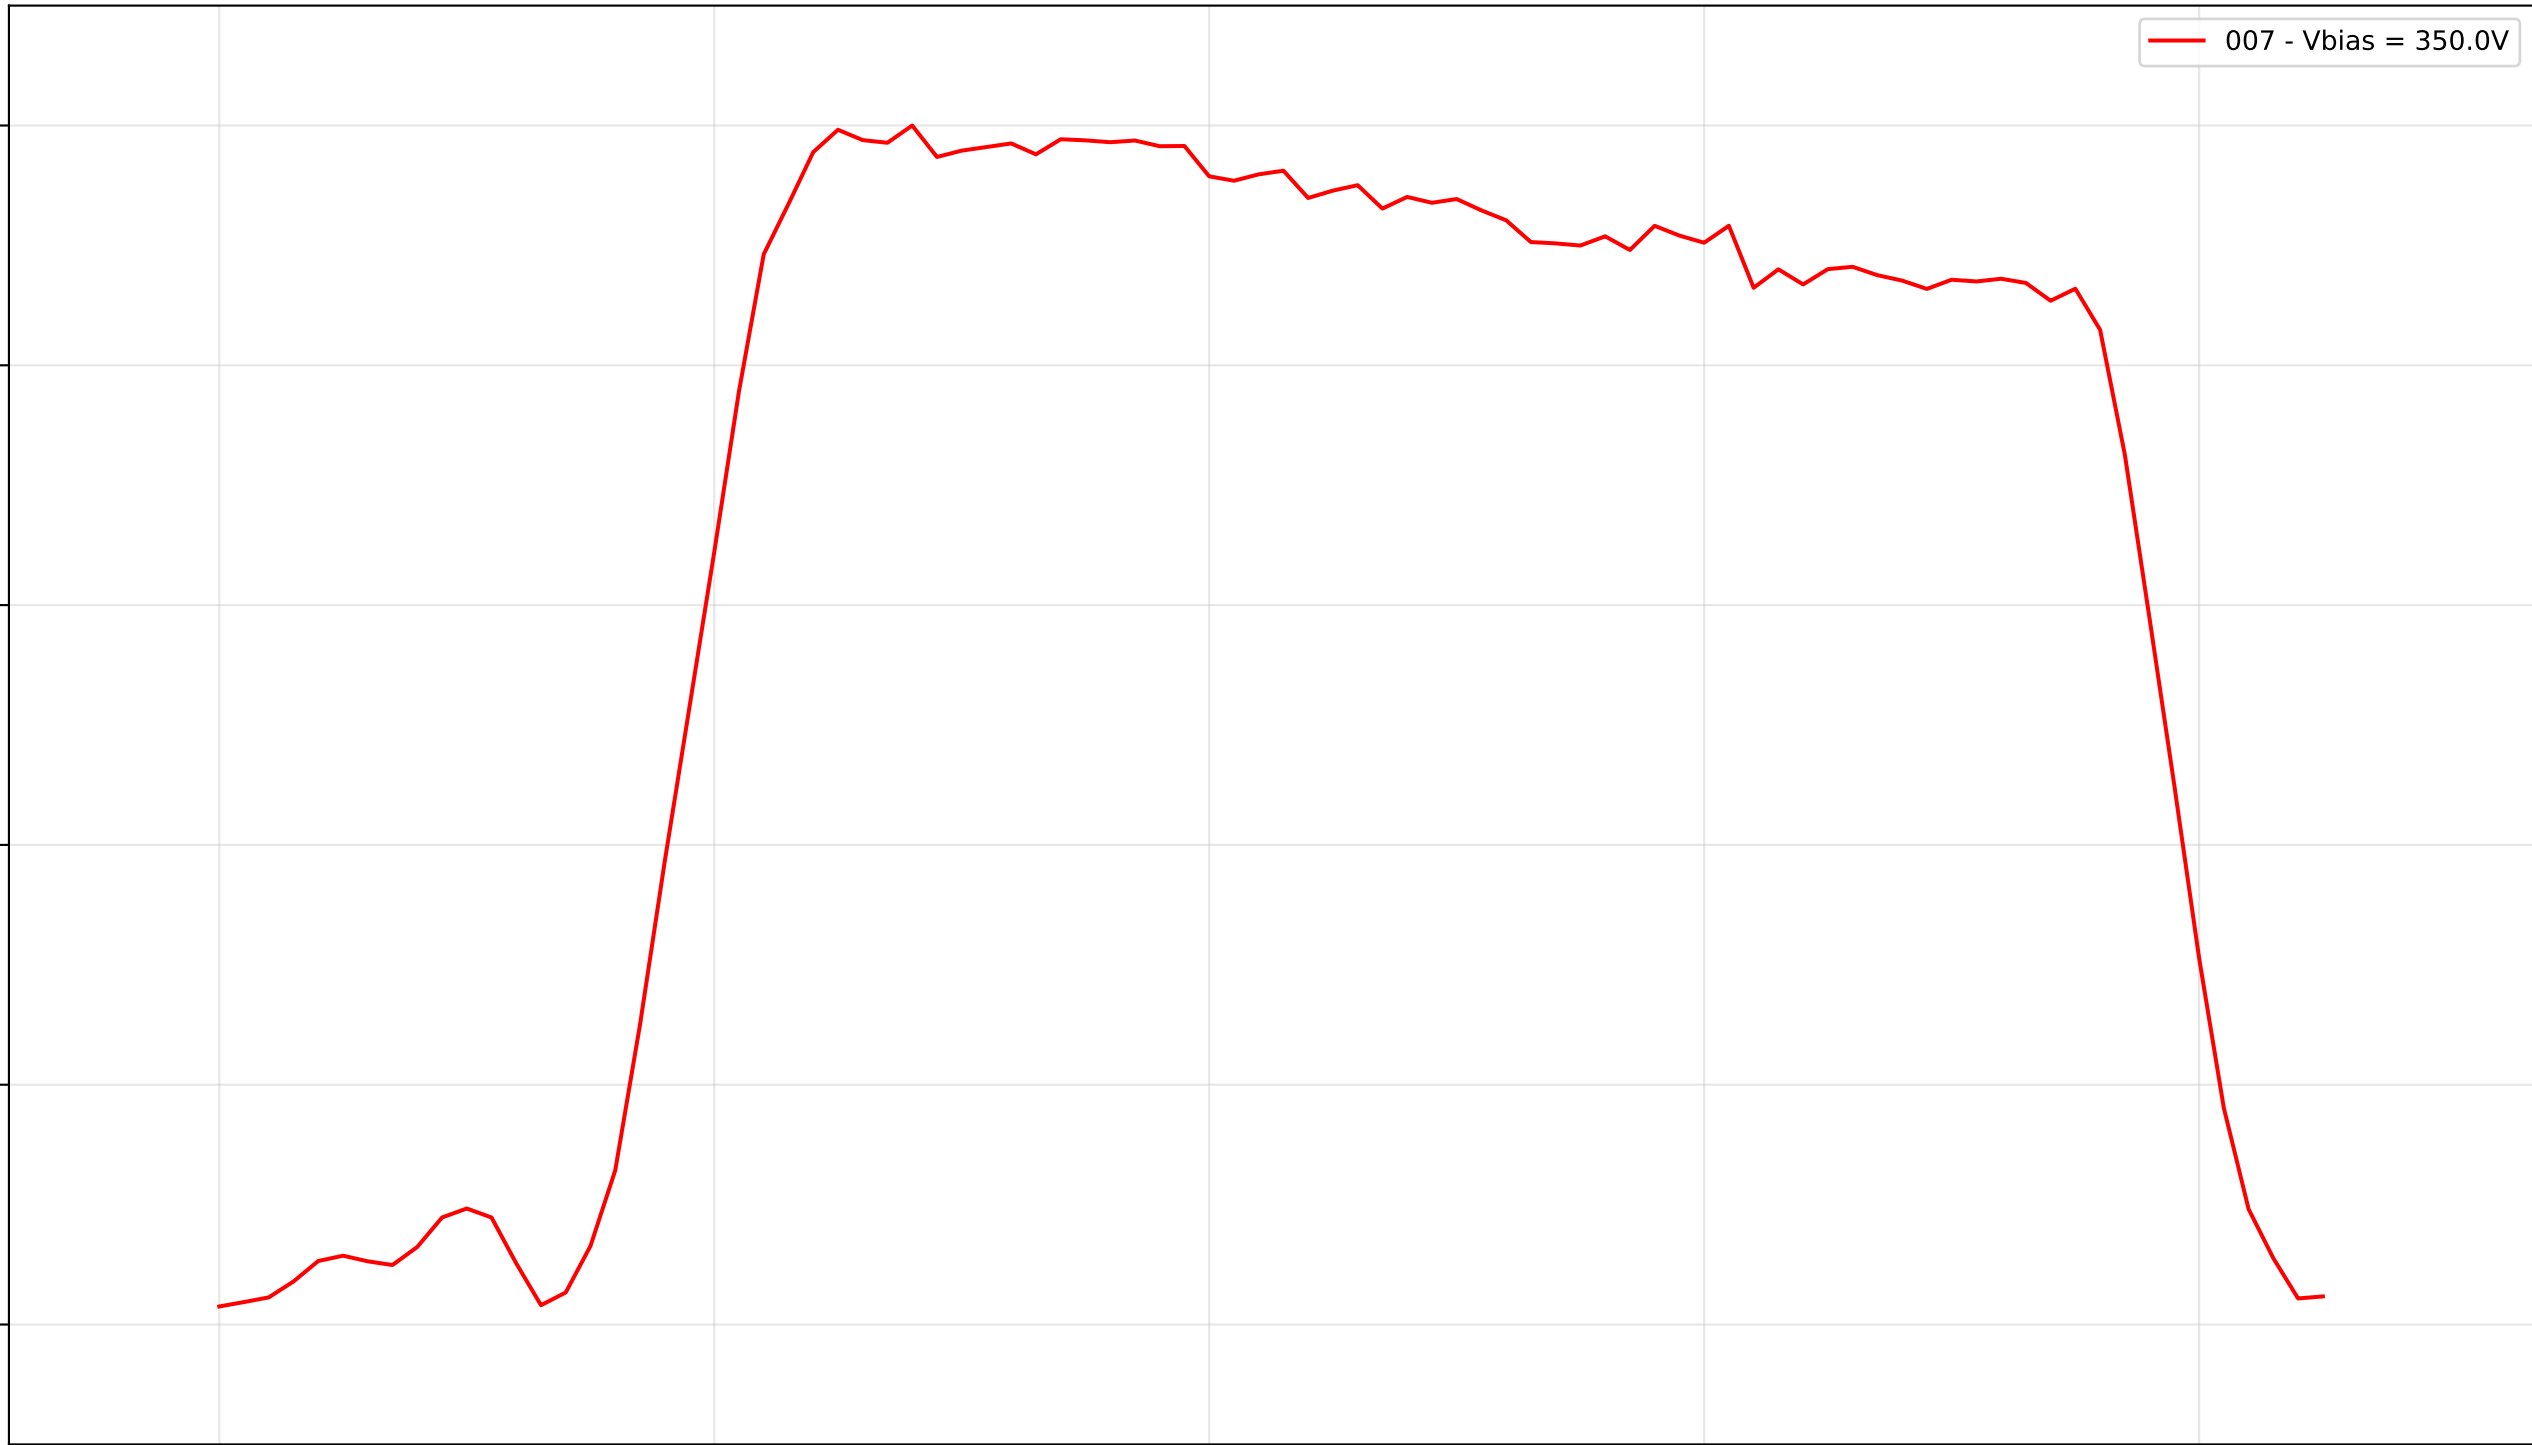


Rise Time

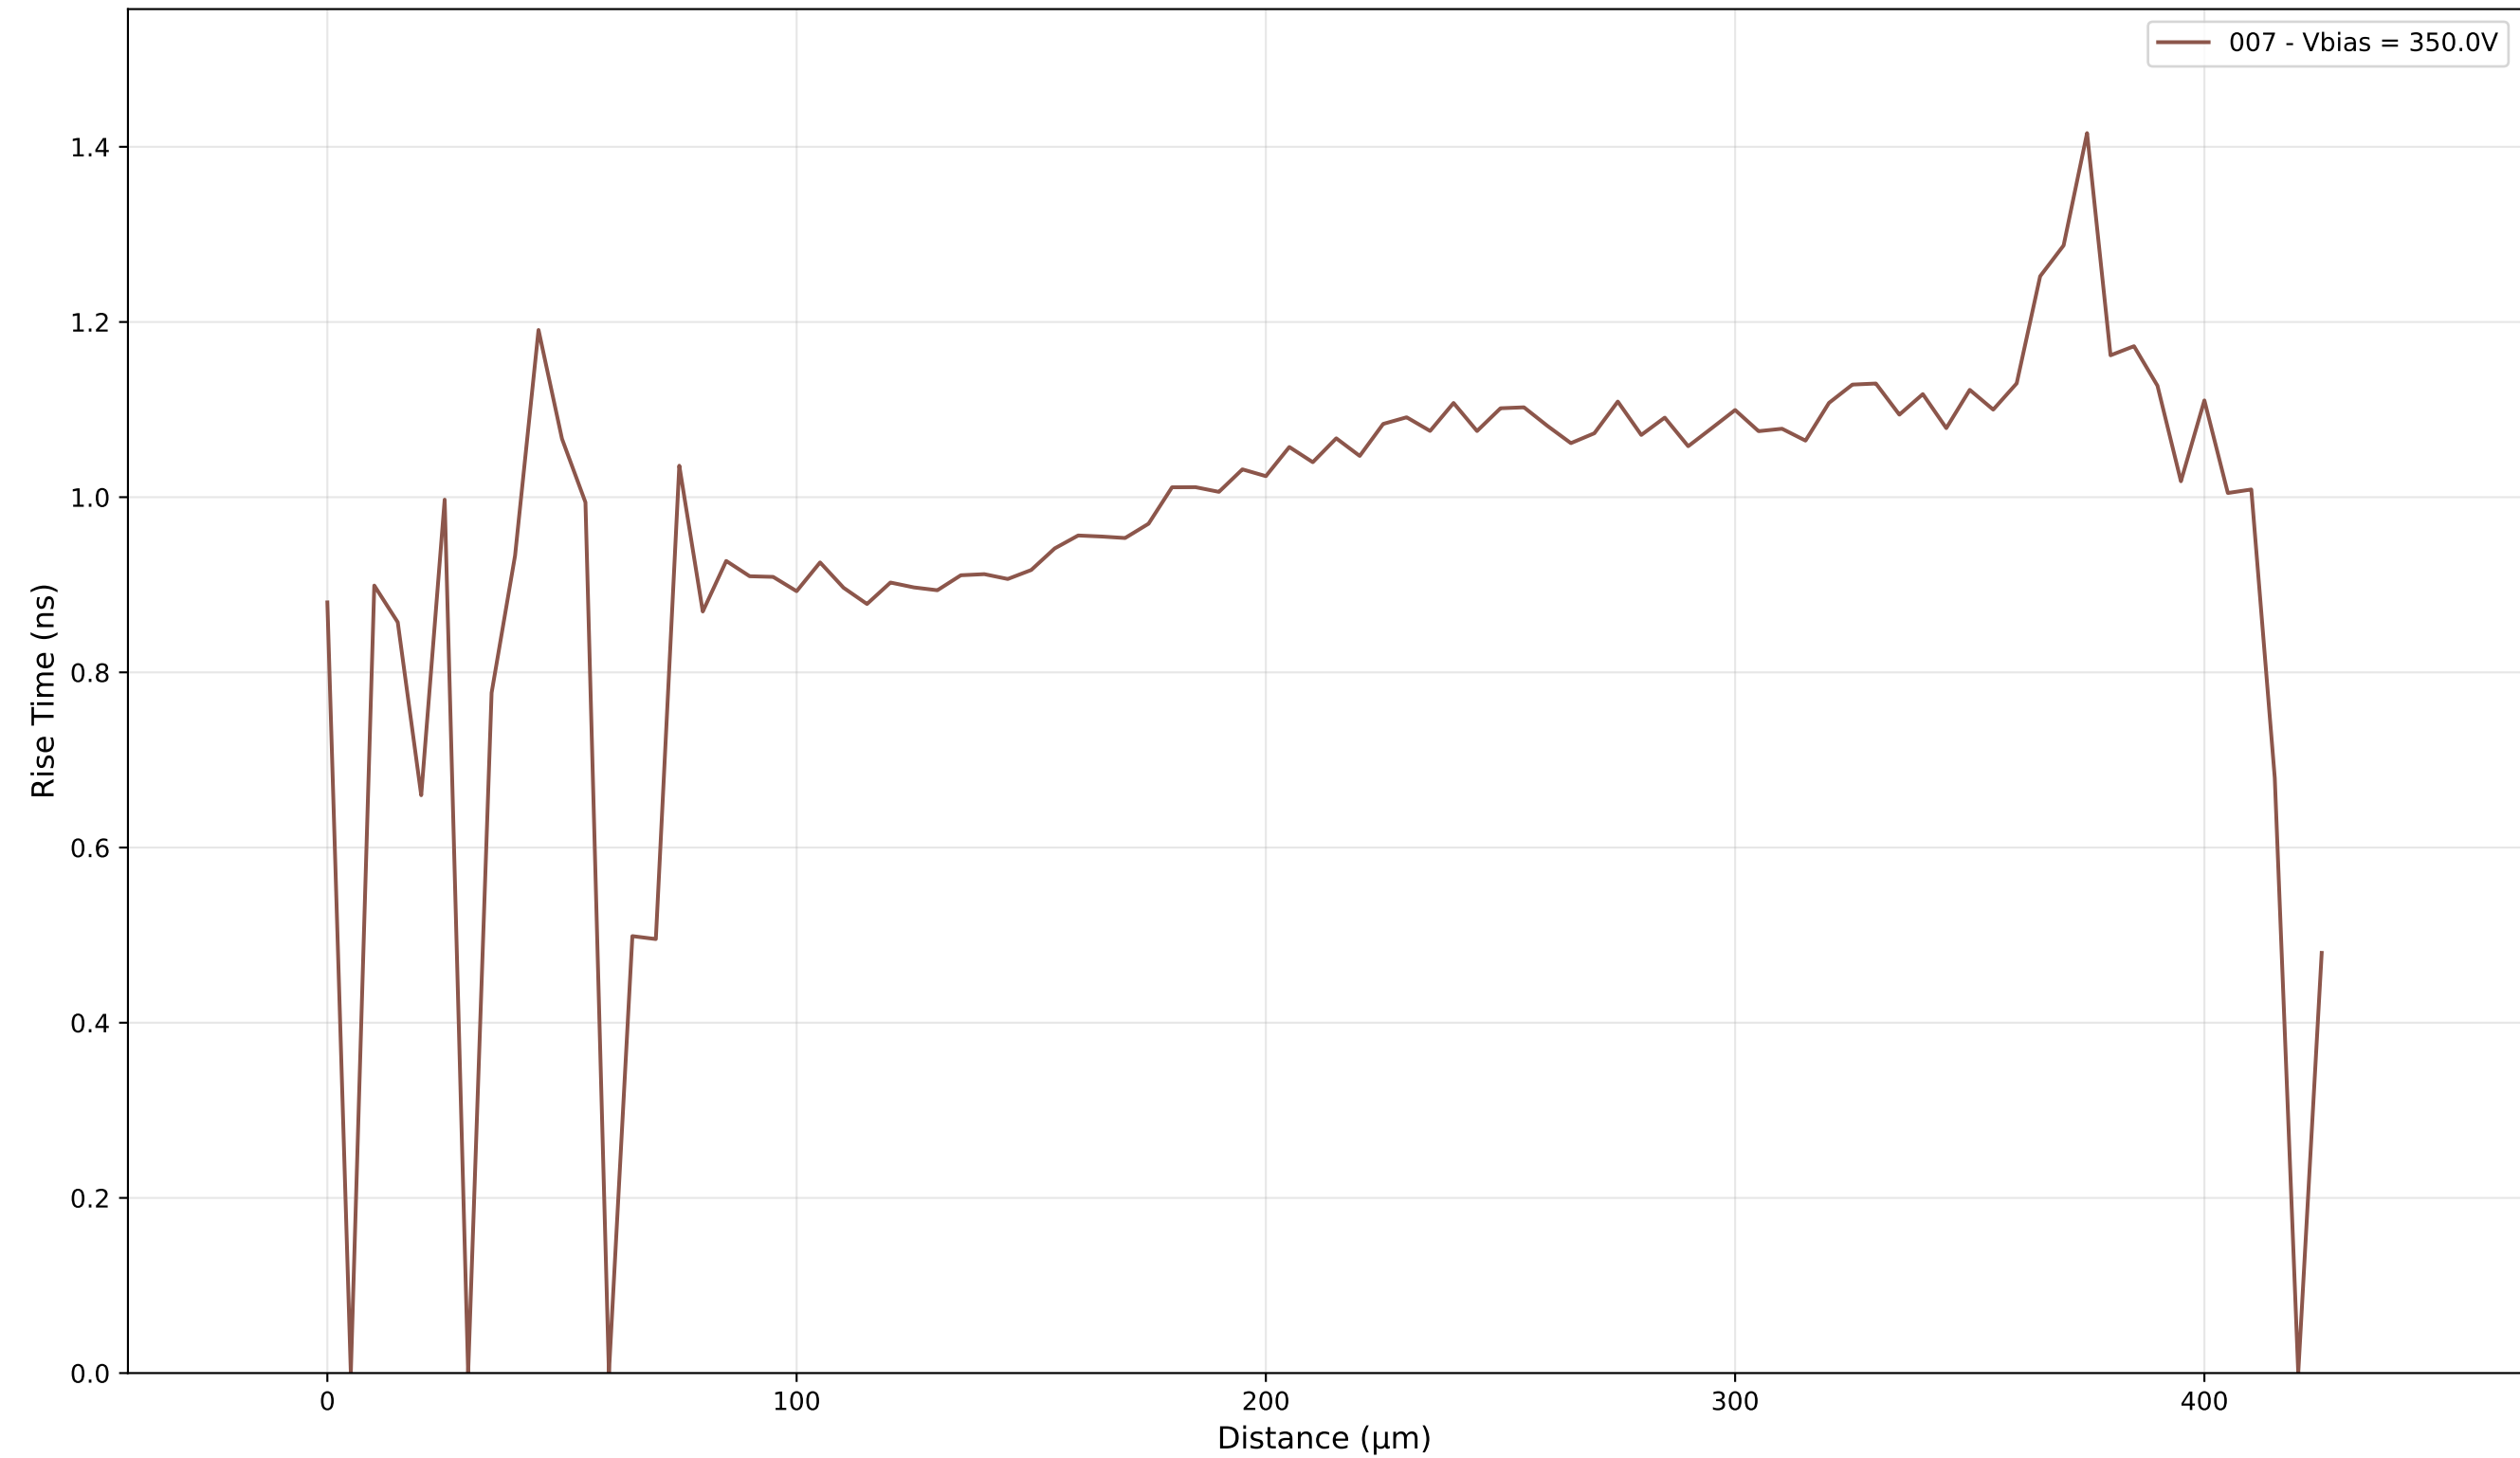

Amplitude

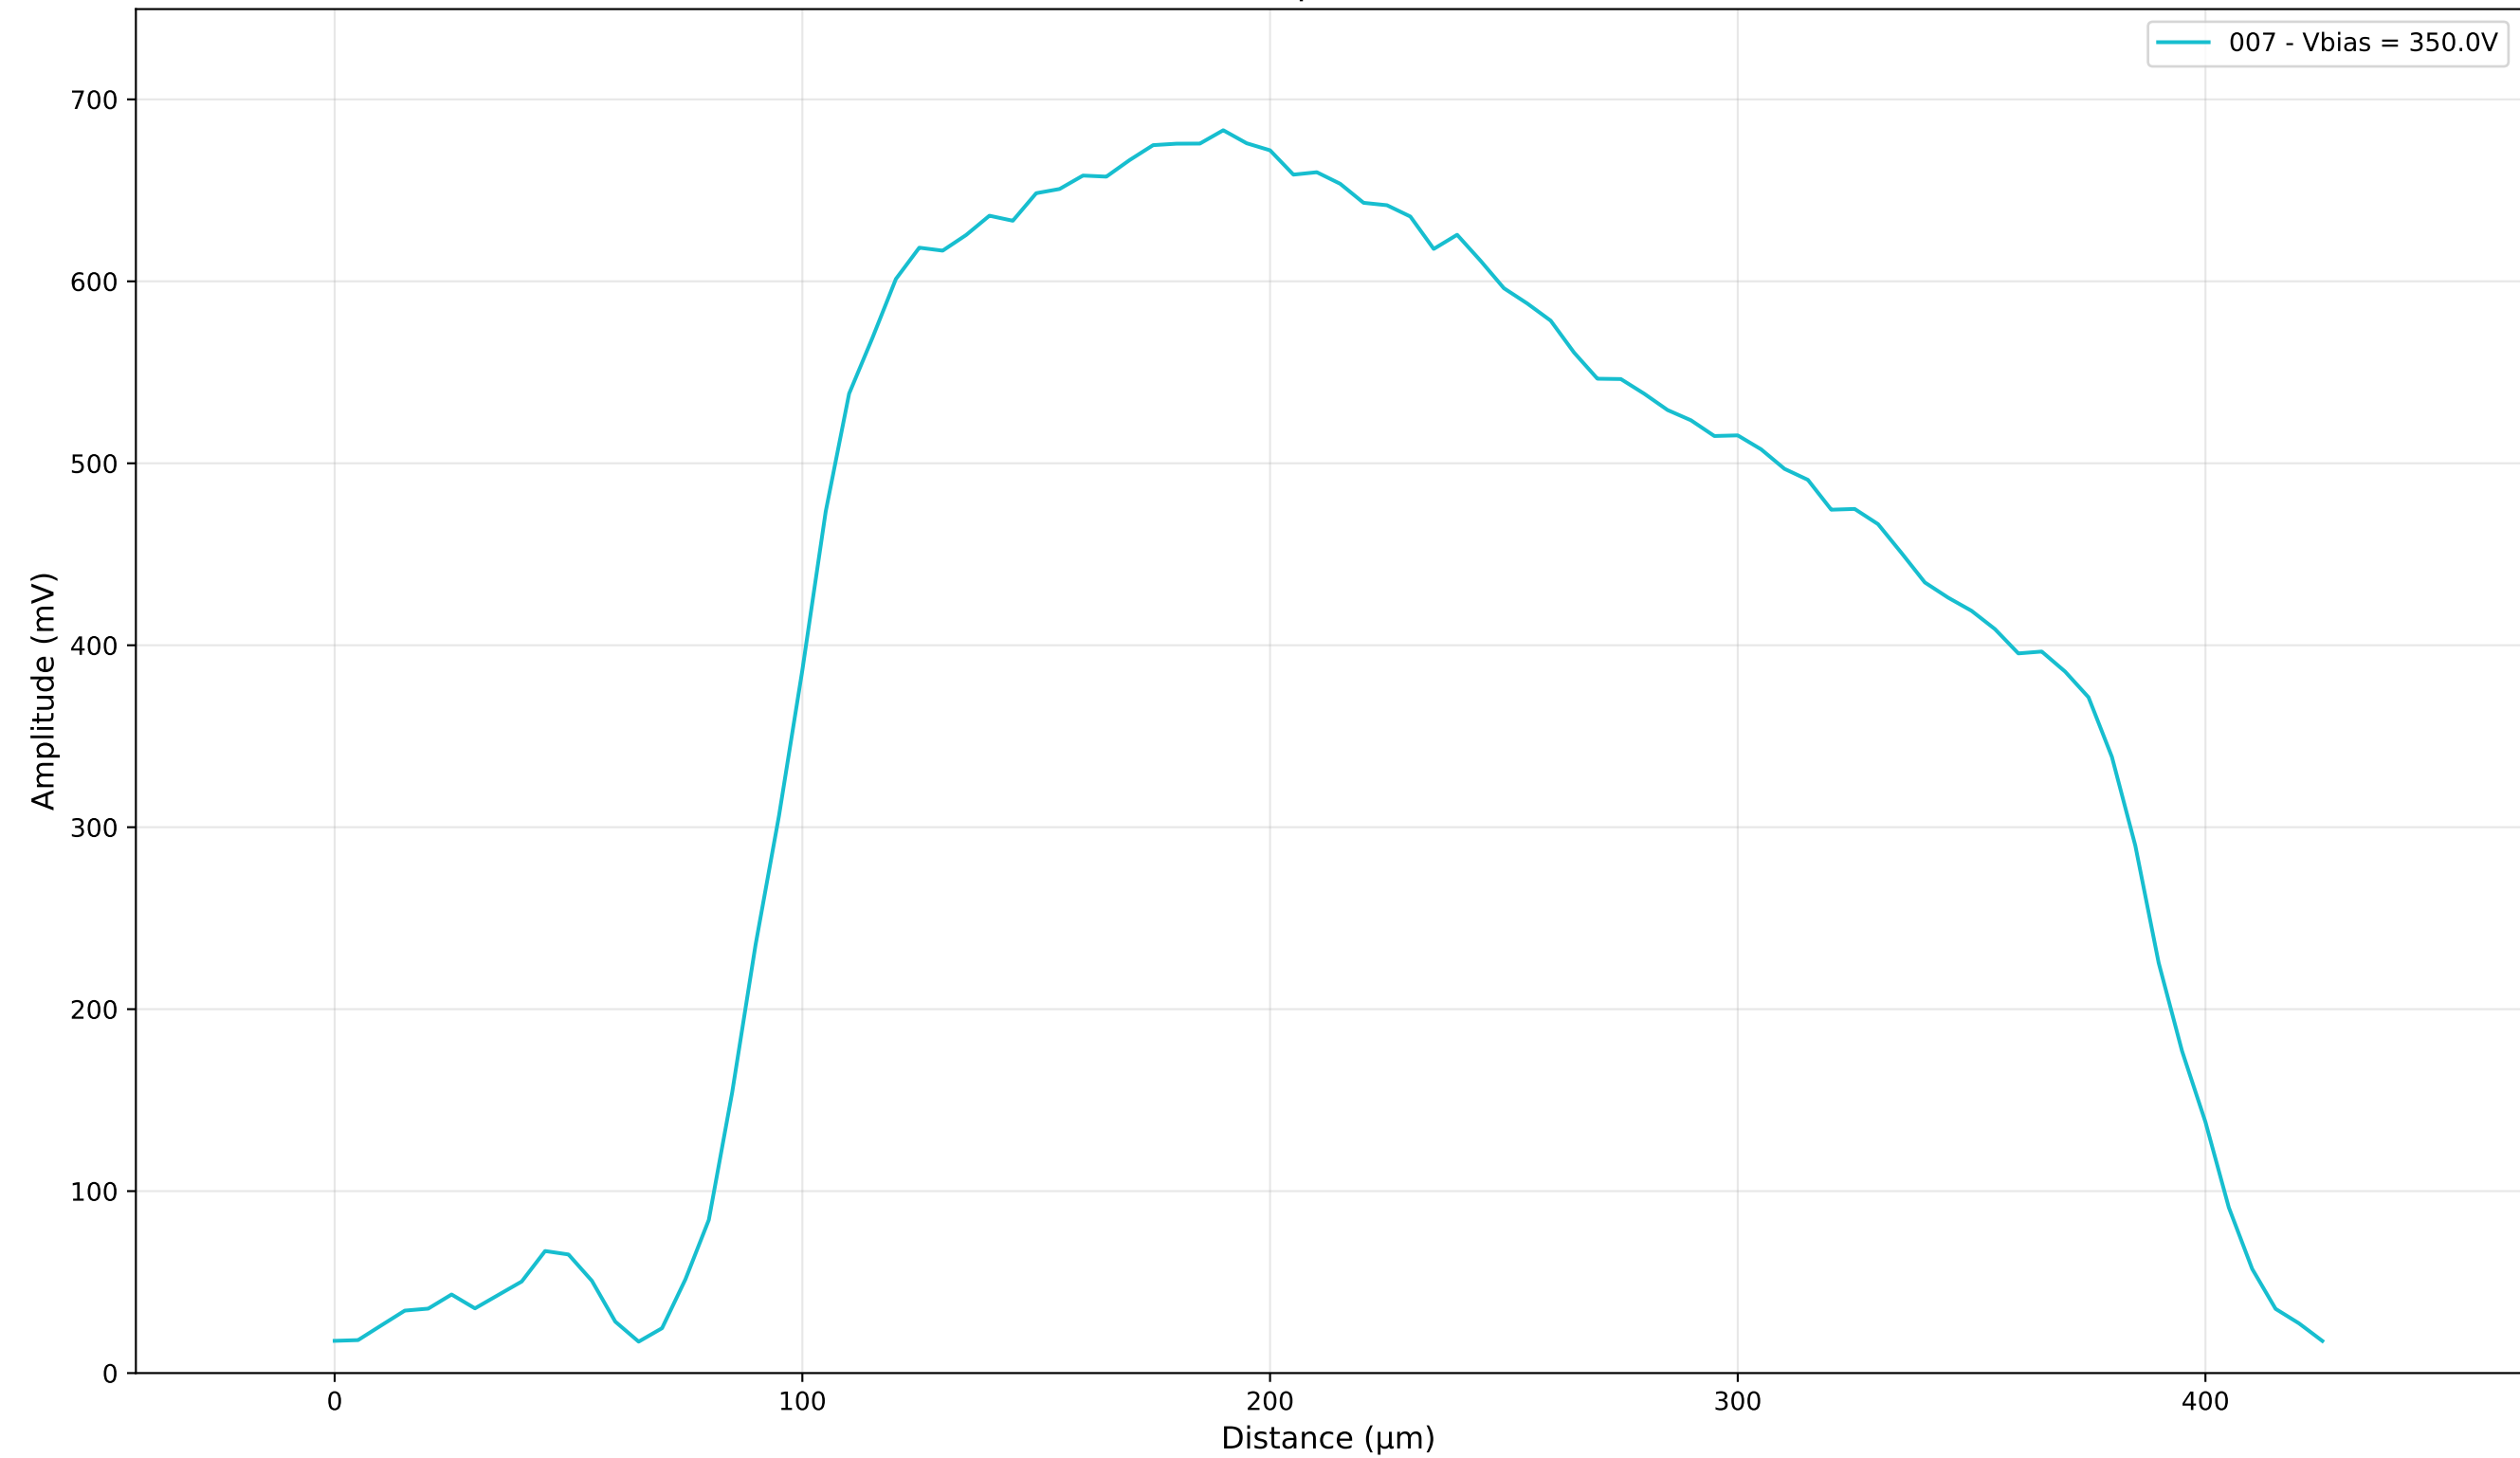

FWHM

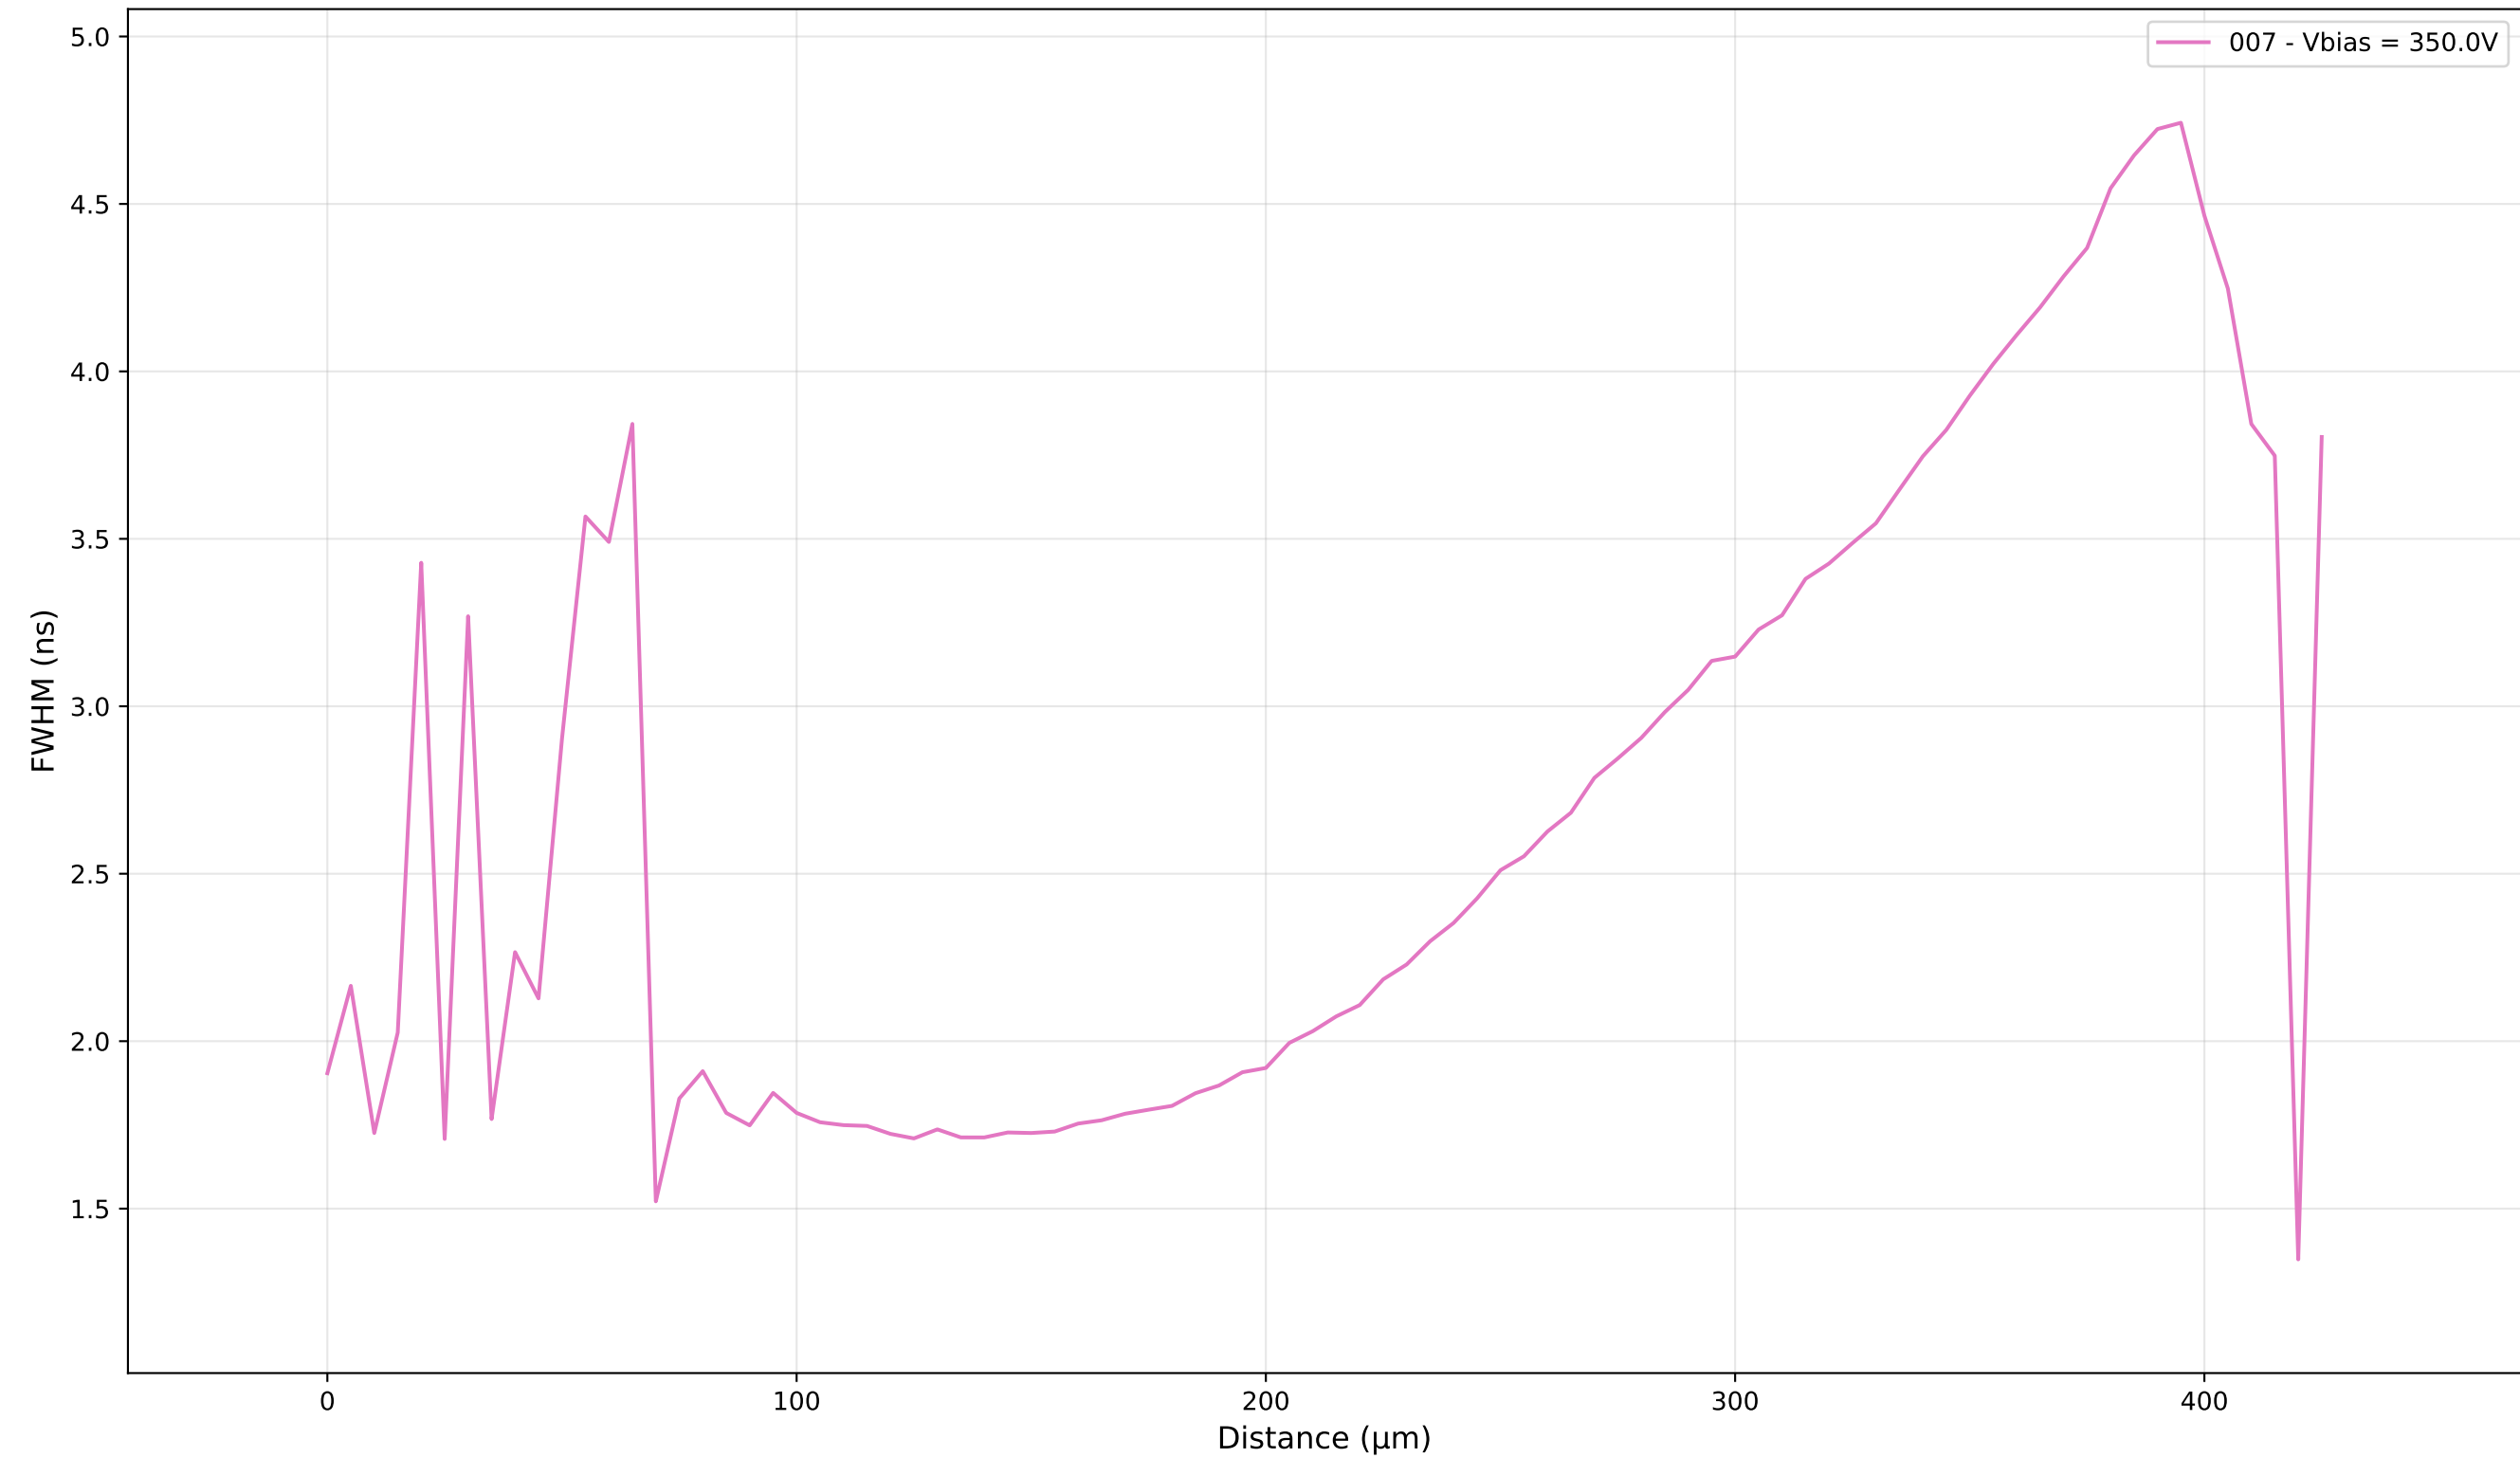


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.55 pC - Rise Time: 0.88 ns




Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.68 pC - Rise Time: 0.00 ns (N/A)




Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.83 pC - Rise Time: 0.90 ns

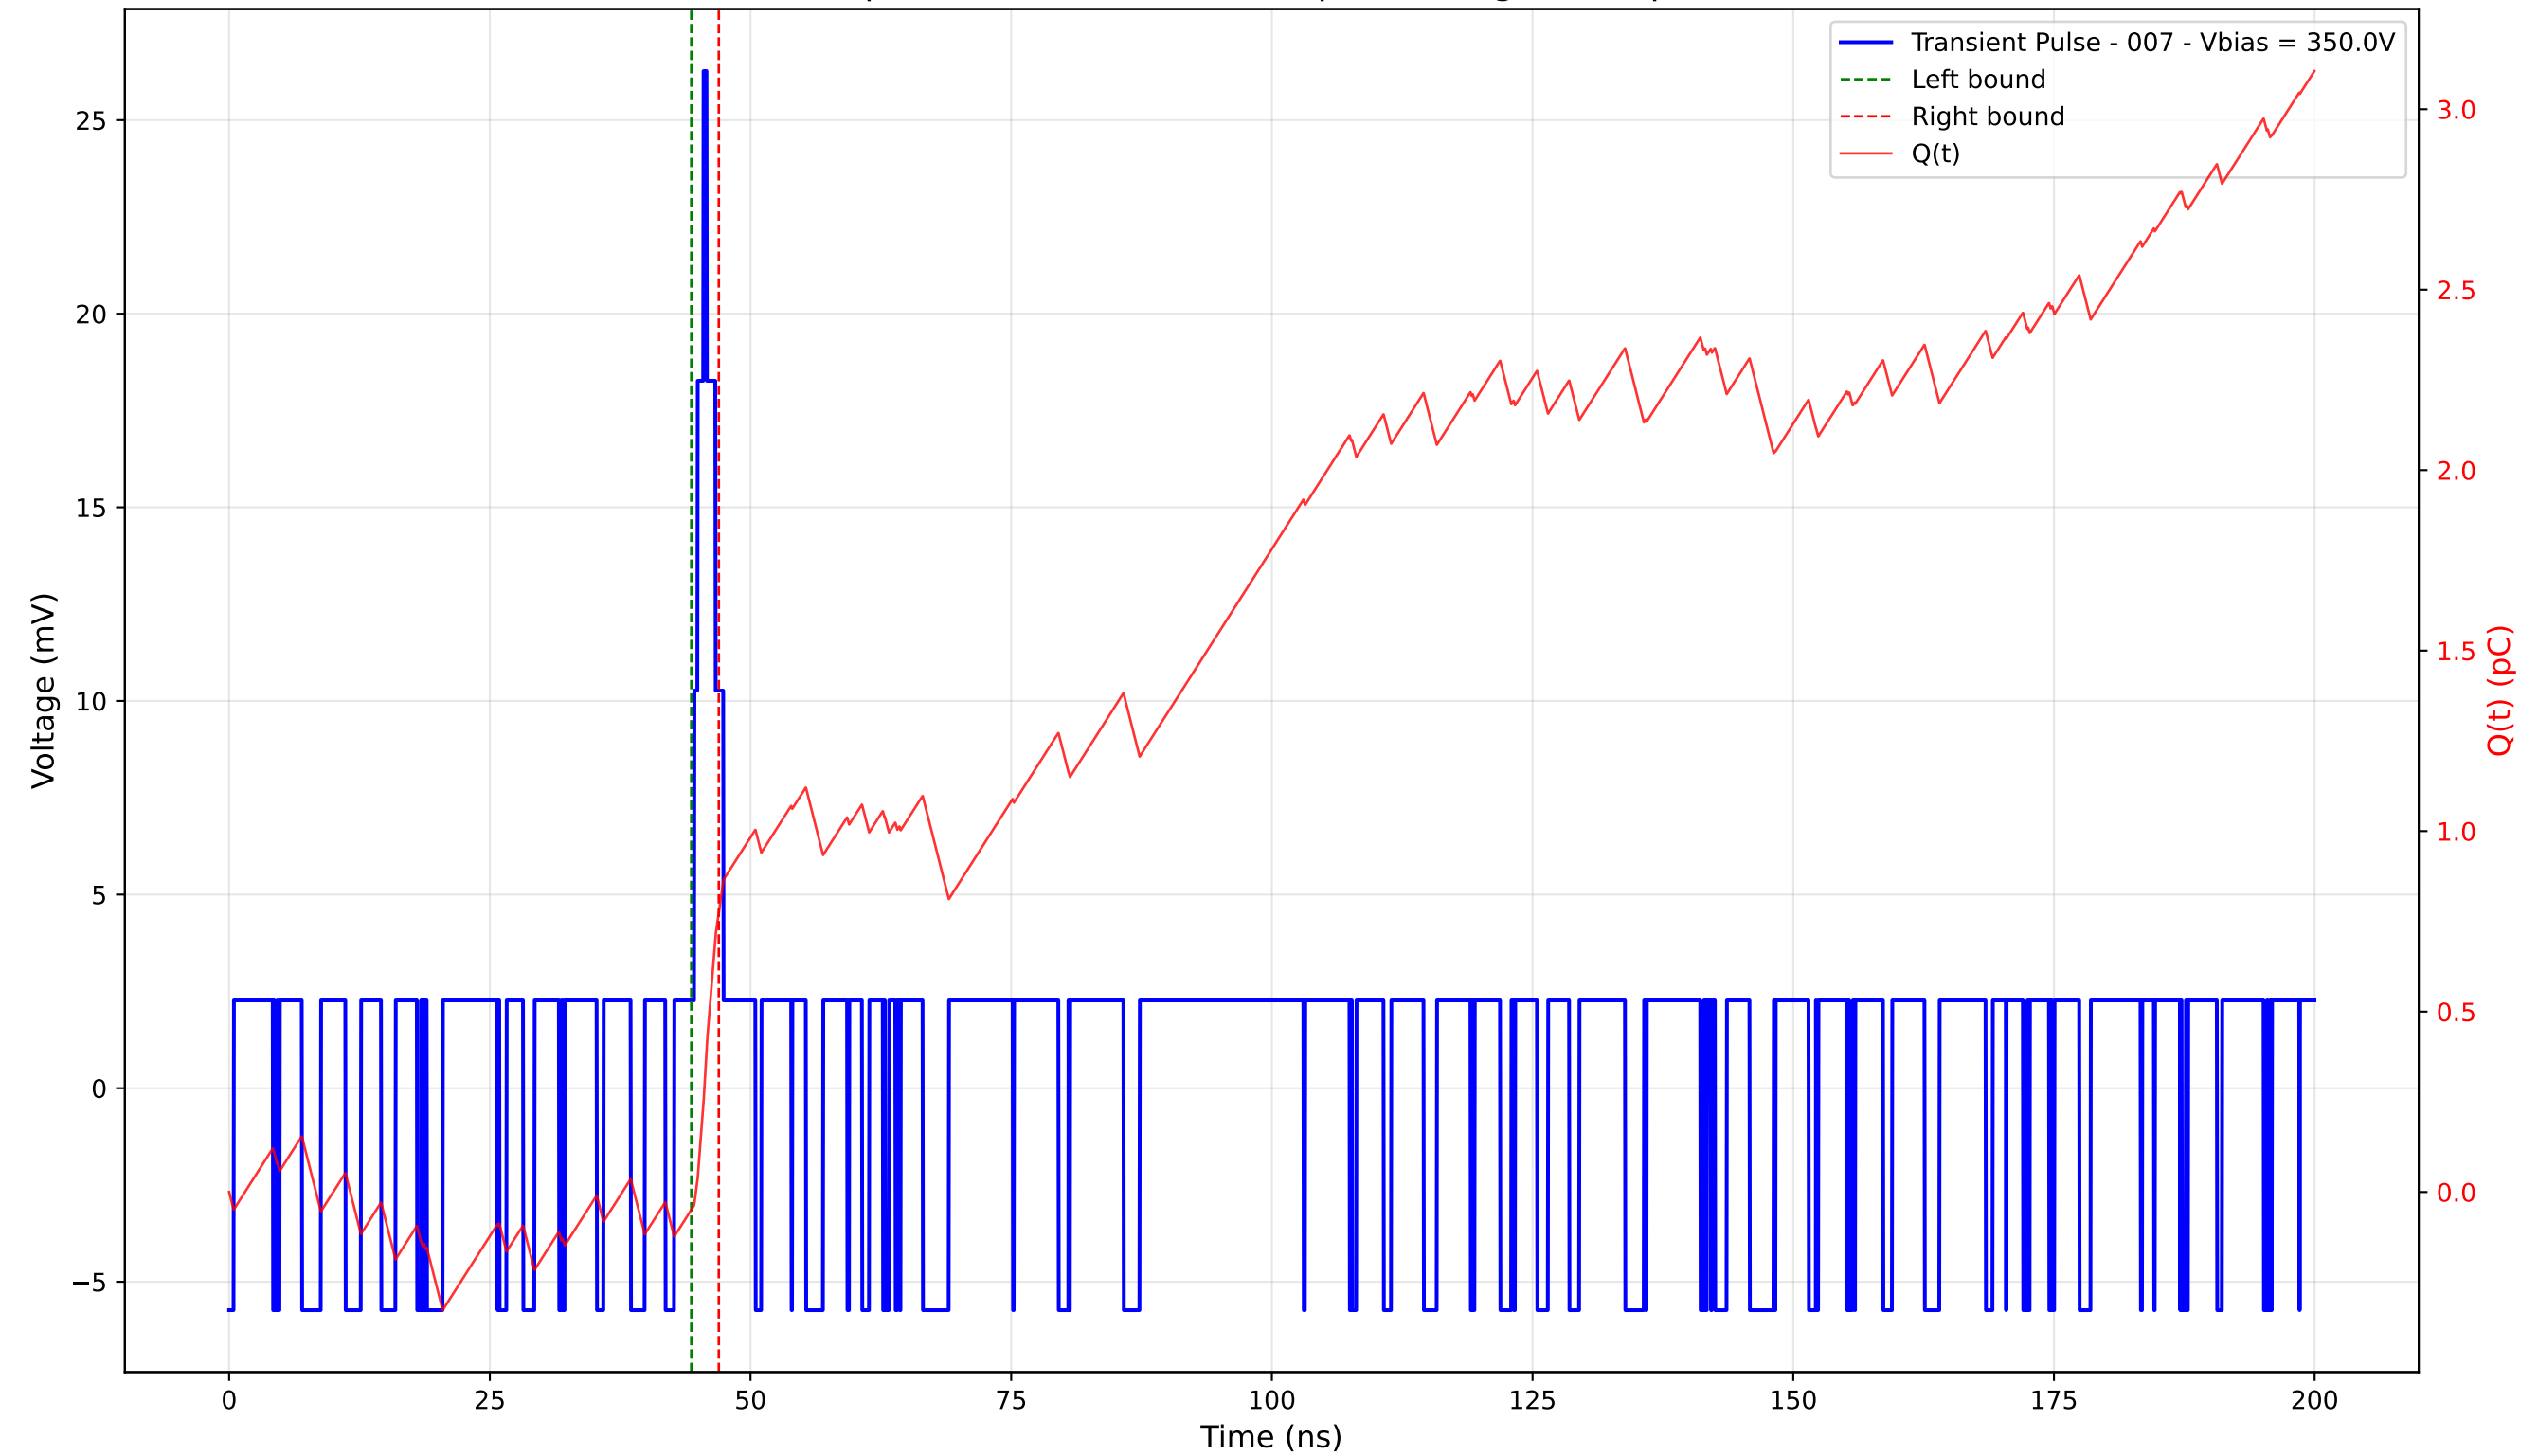


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.31 pC - Rise Time: 0.86 ns

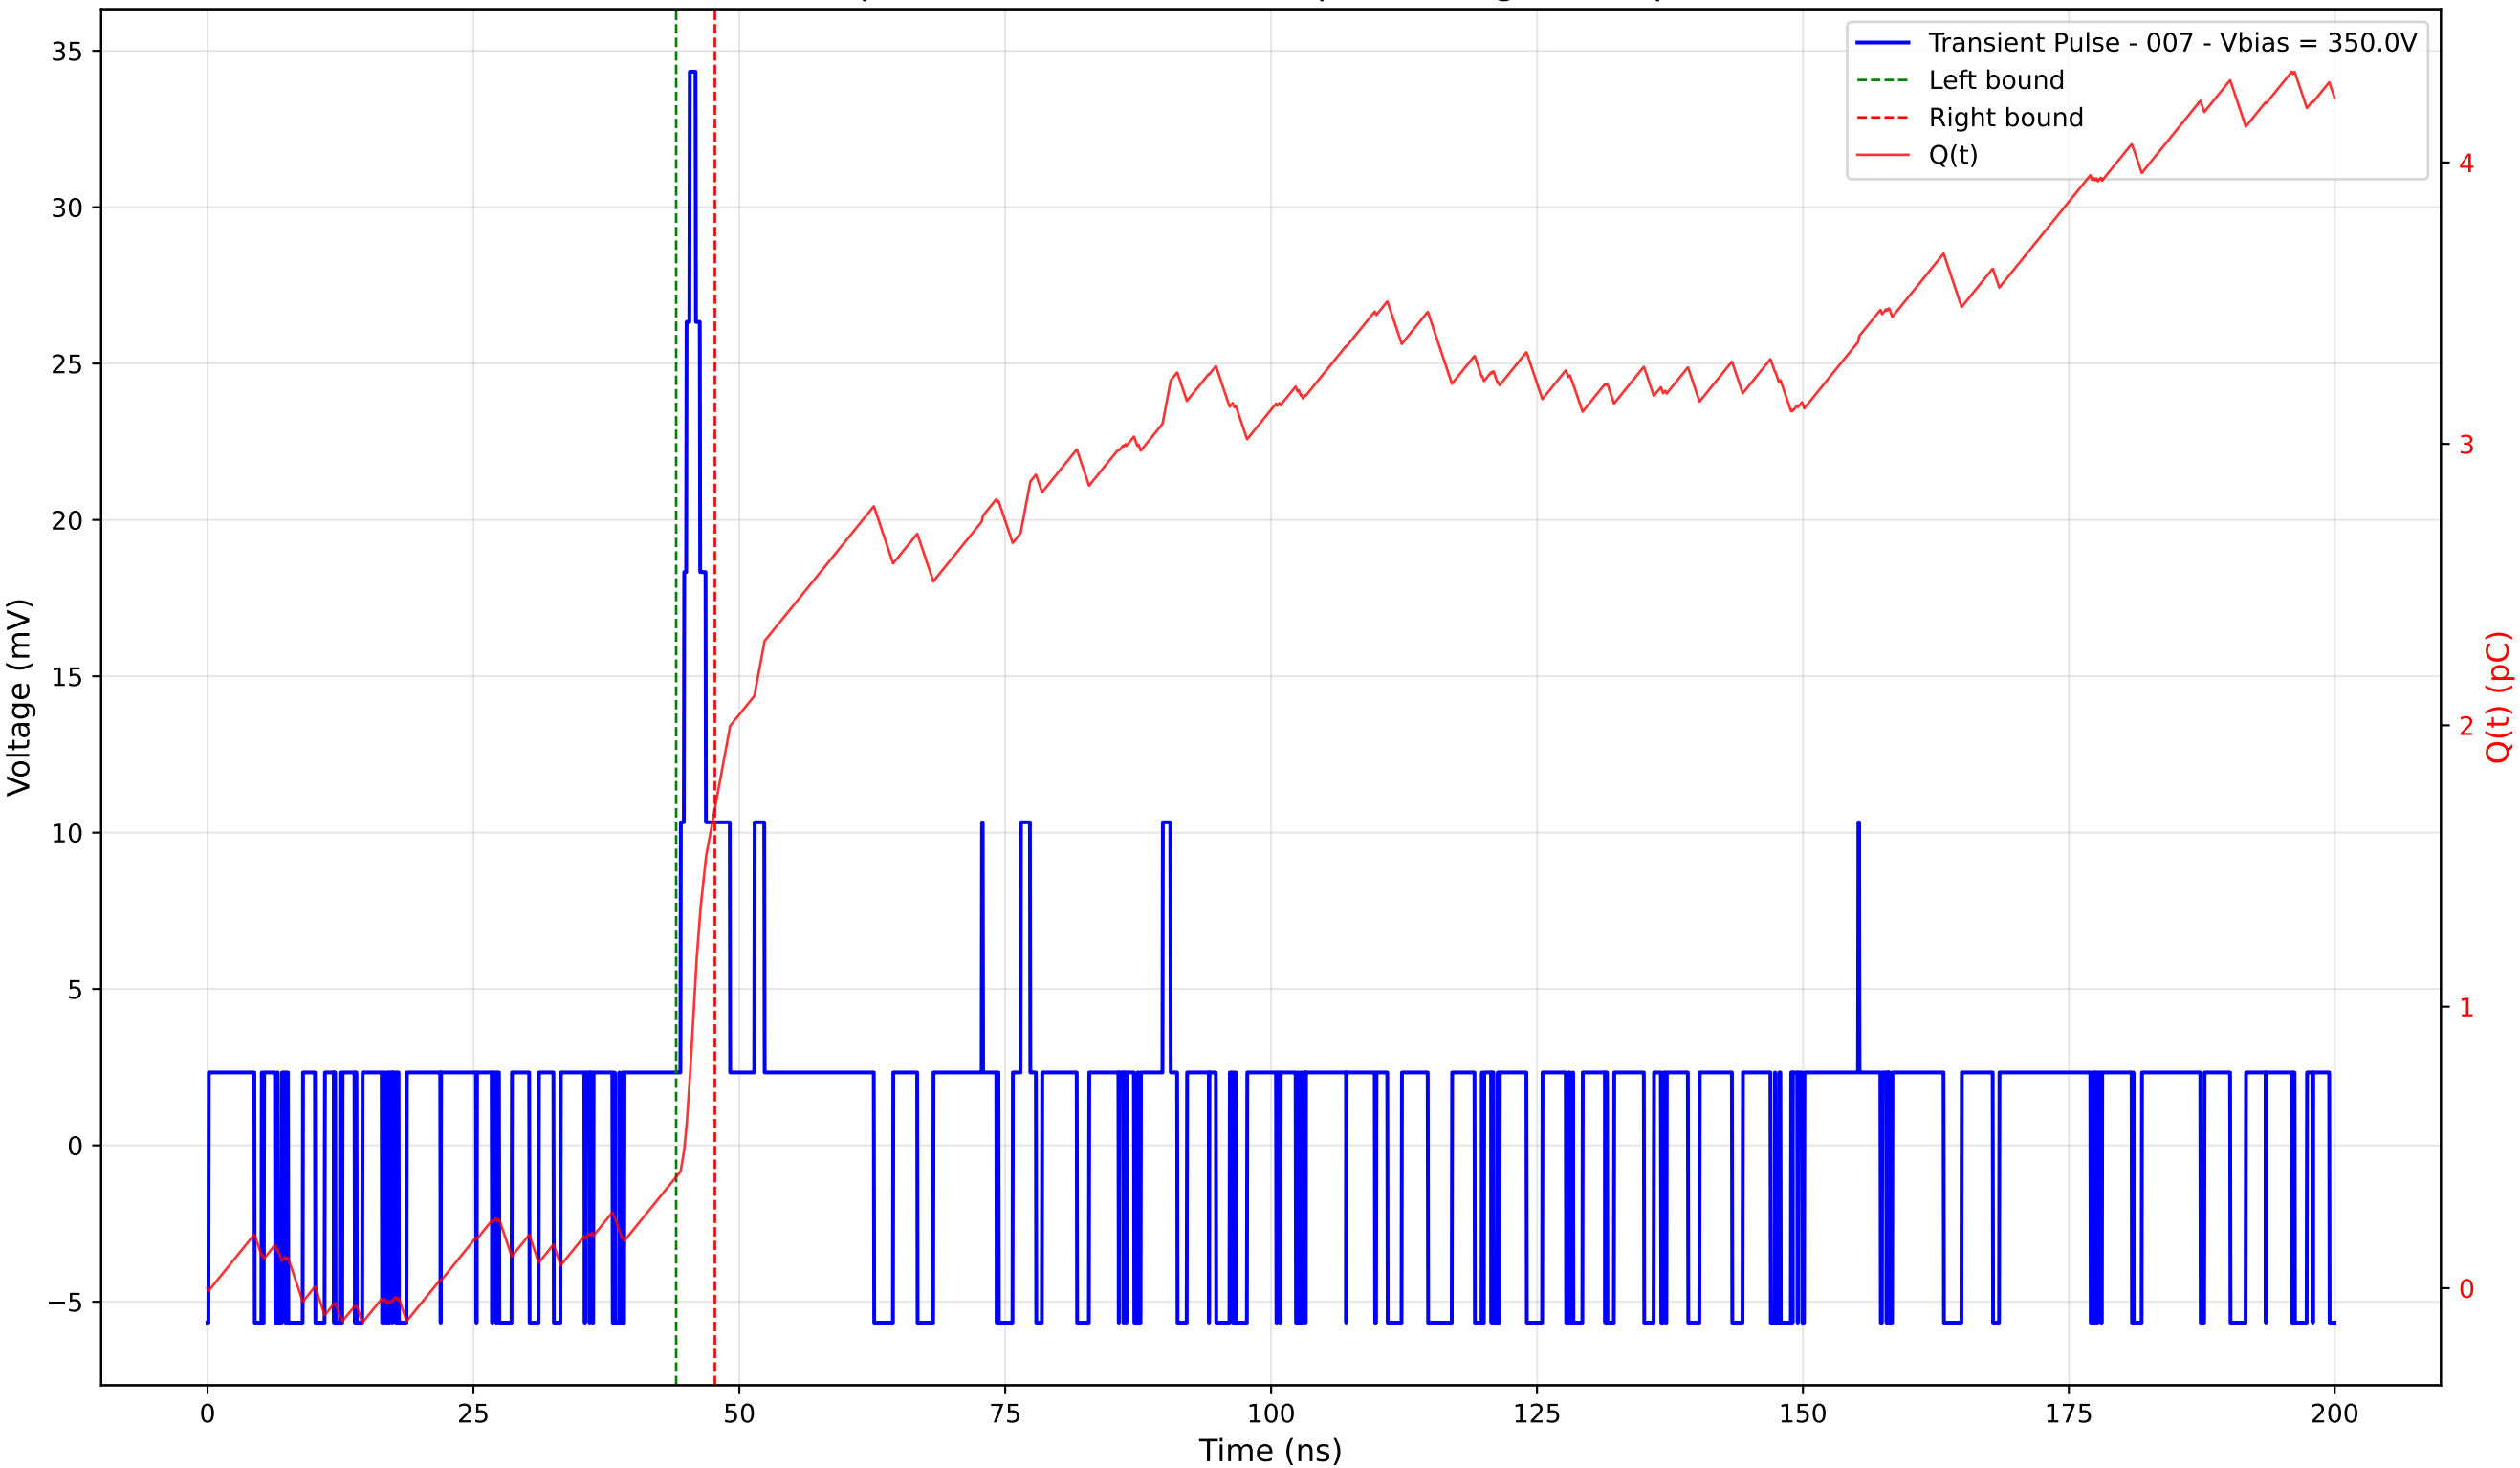


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.93 pC - Rise Time: 0.66 ns

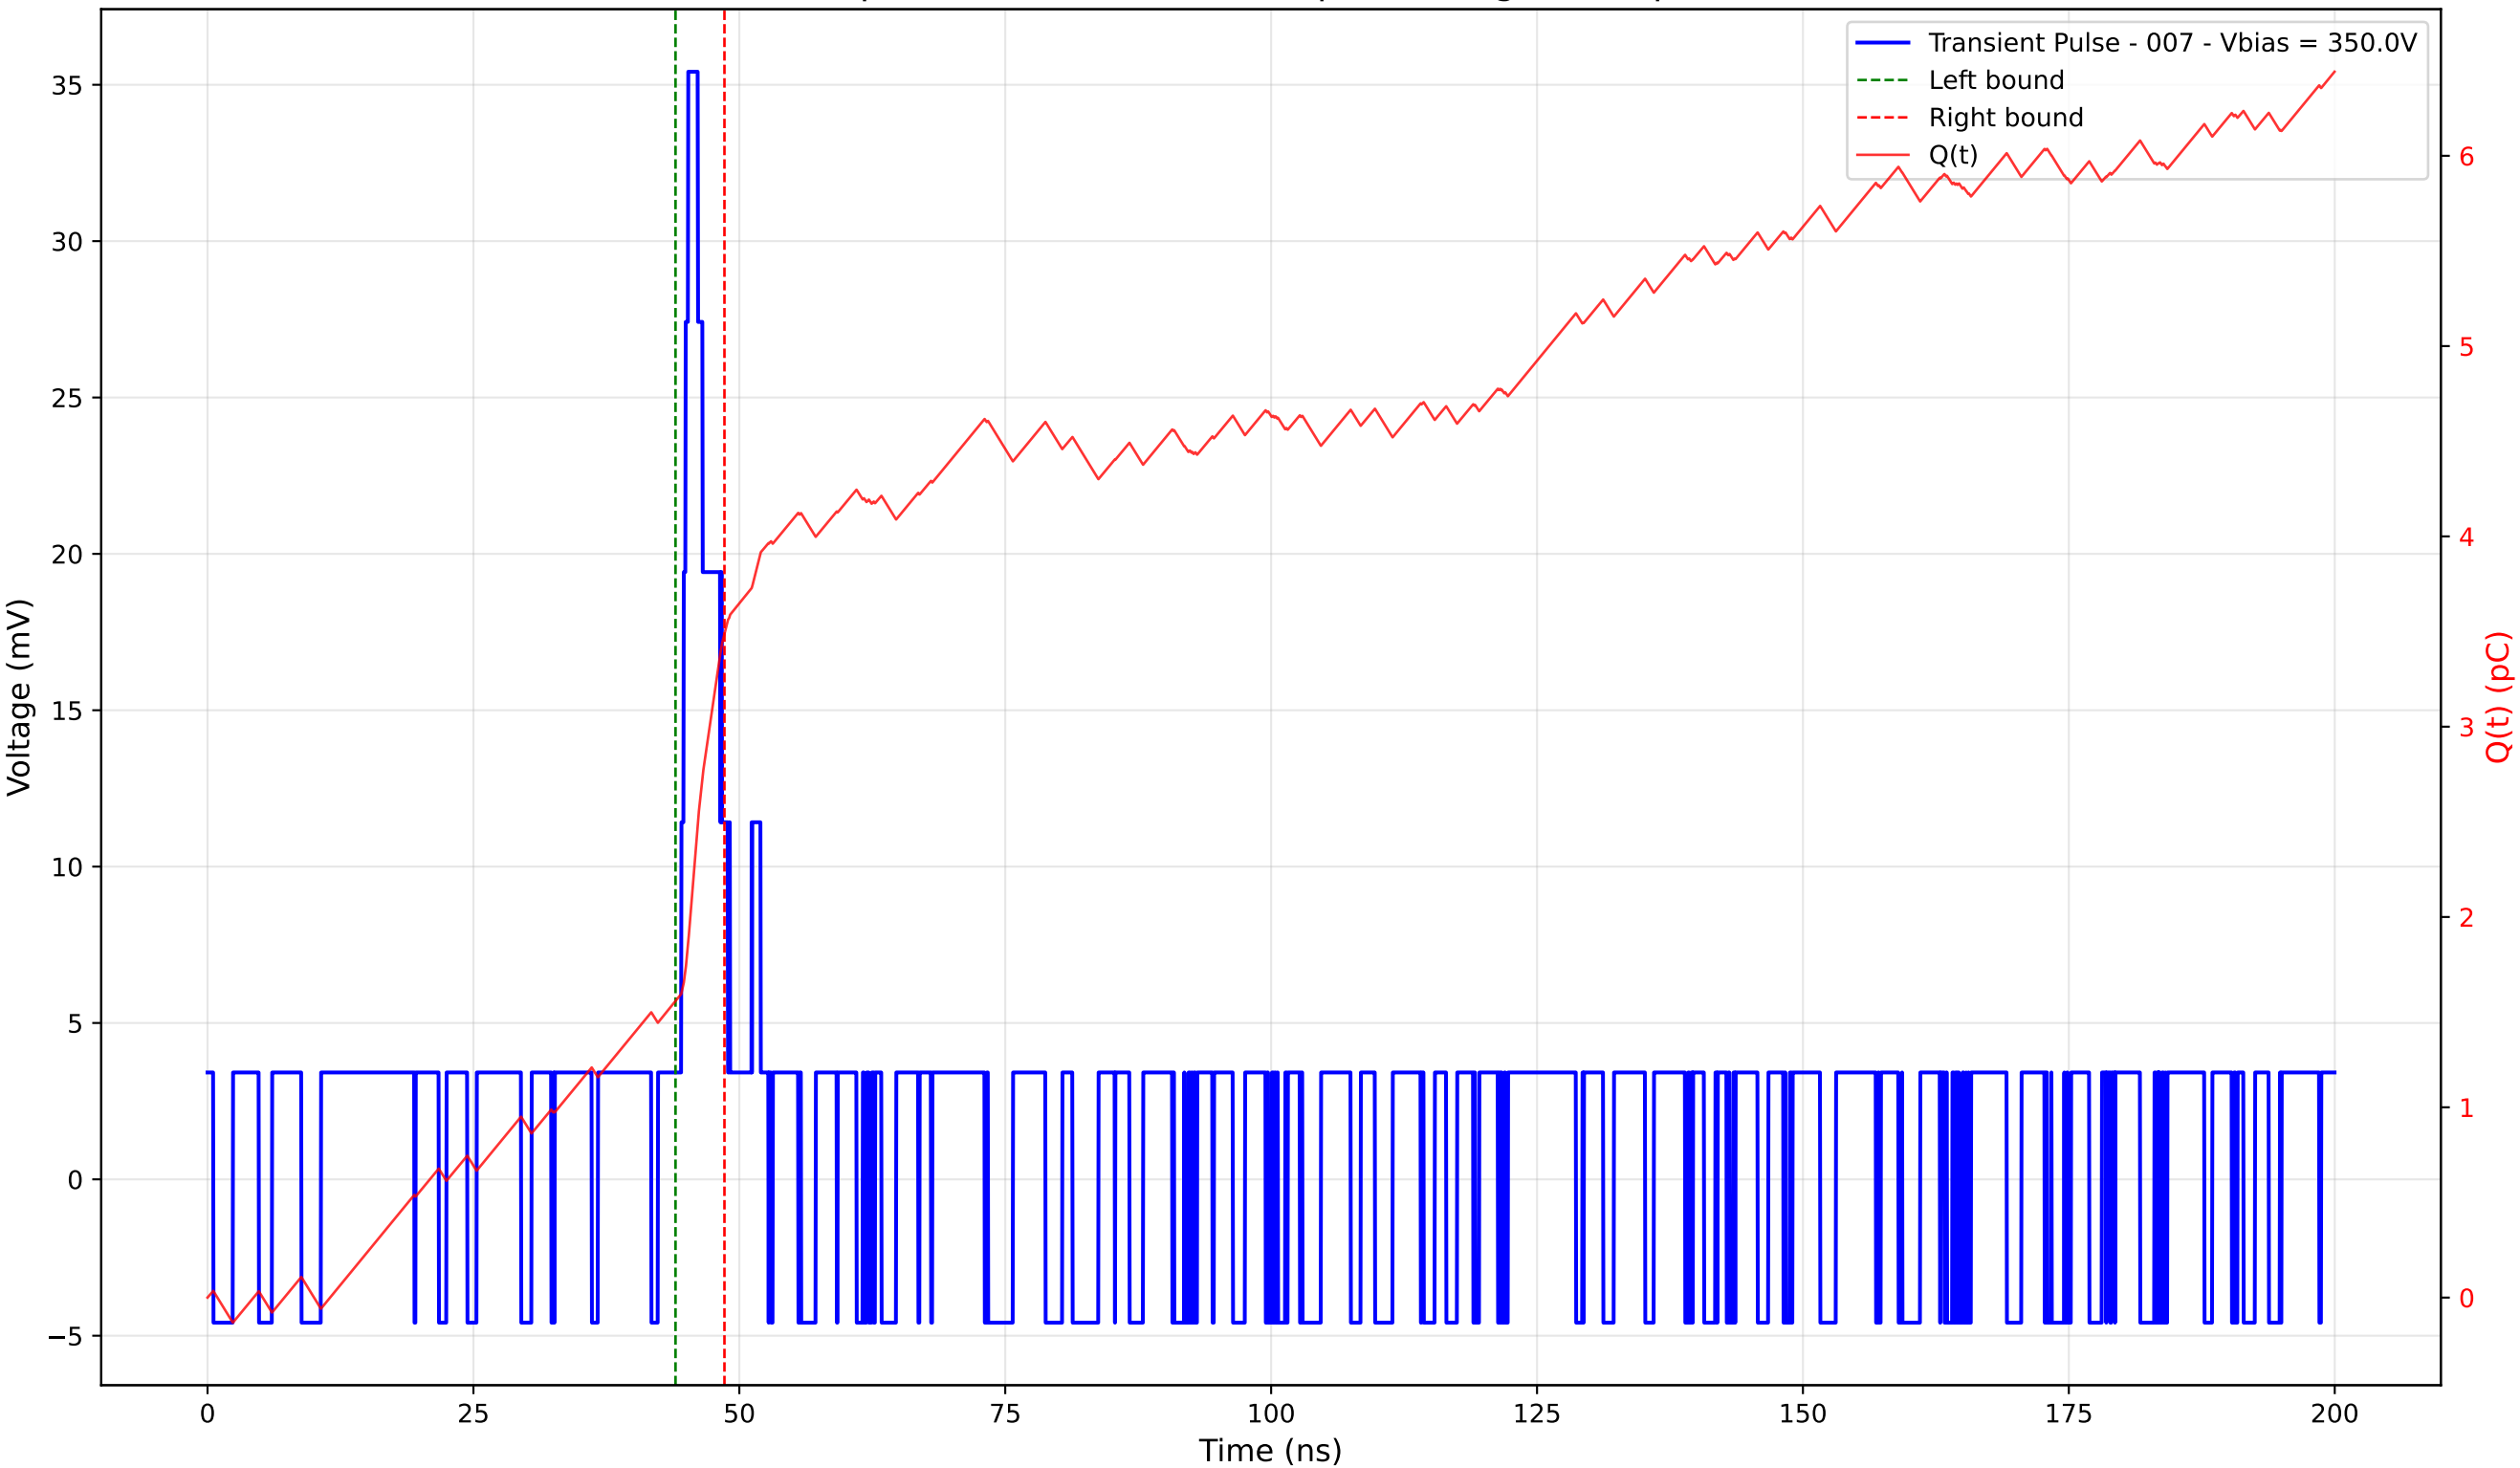


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 2.09 pC - Rise Time: 1.00 ns

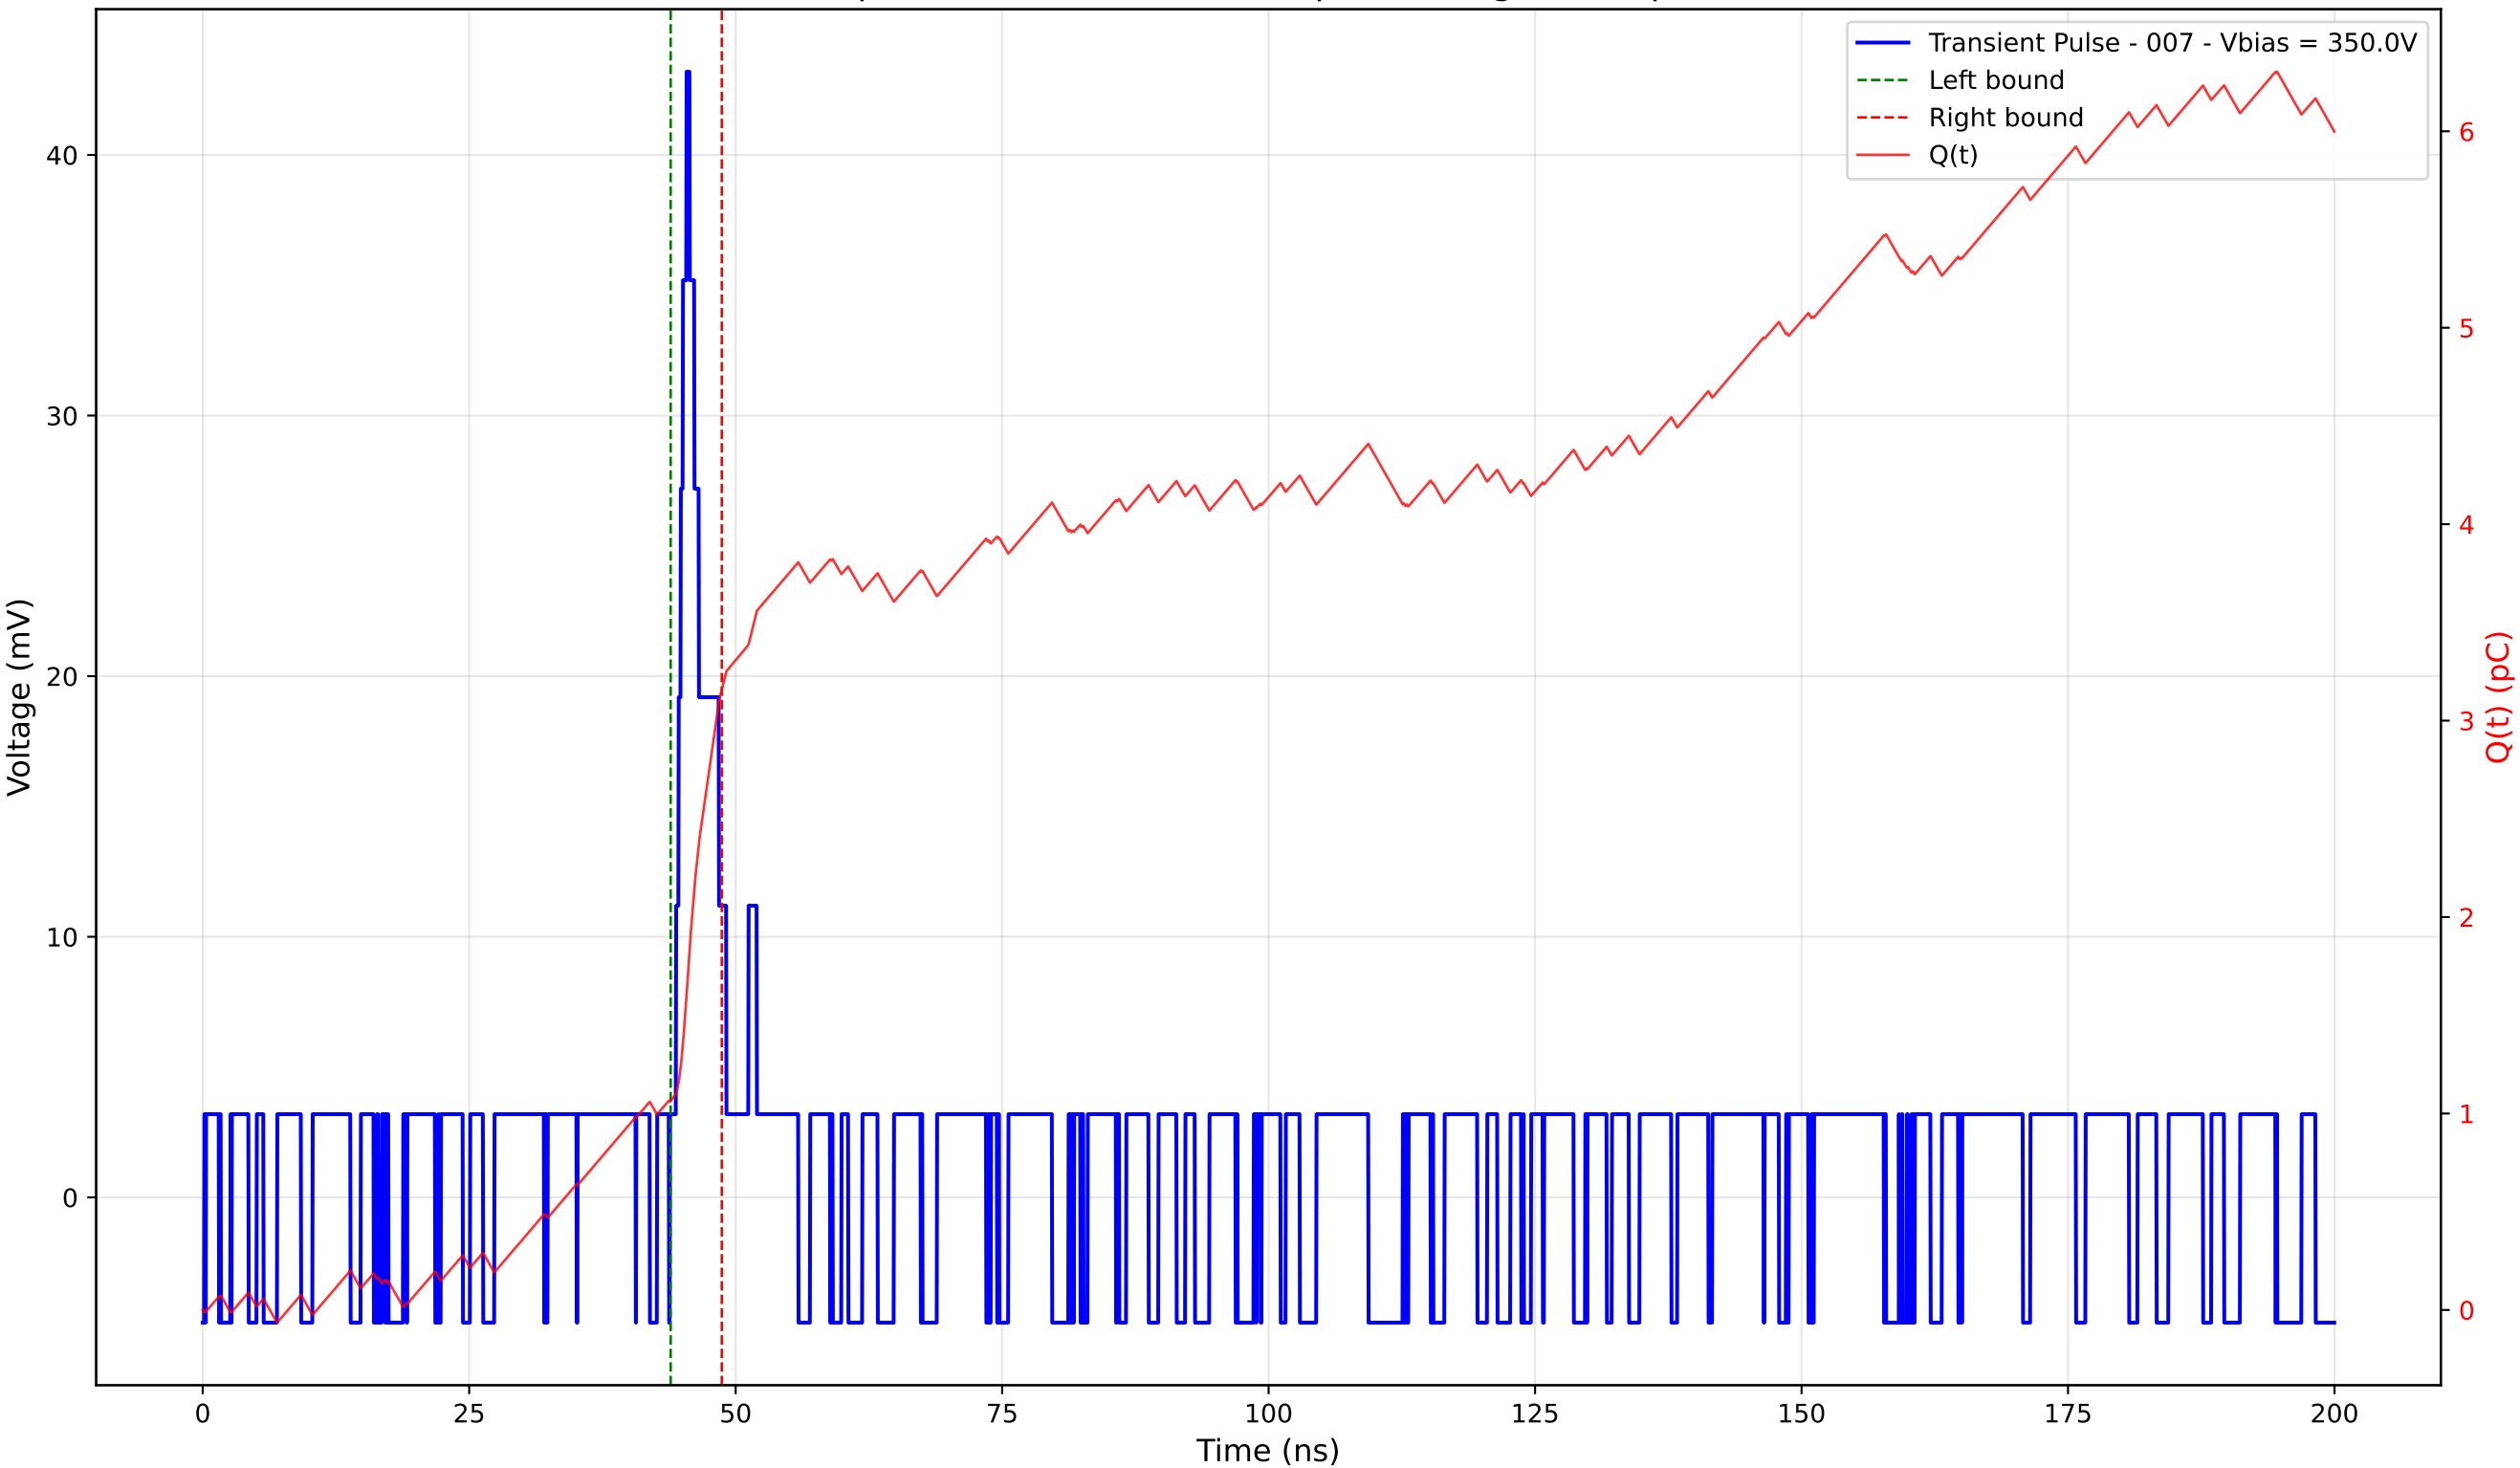


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.92 pC - Rise Time: 0.00 ns (N/A)

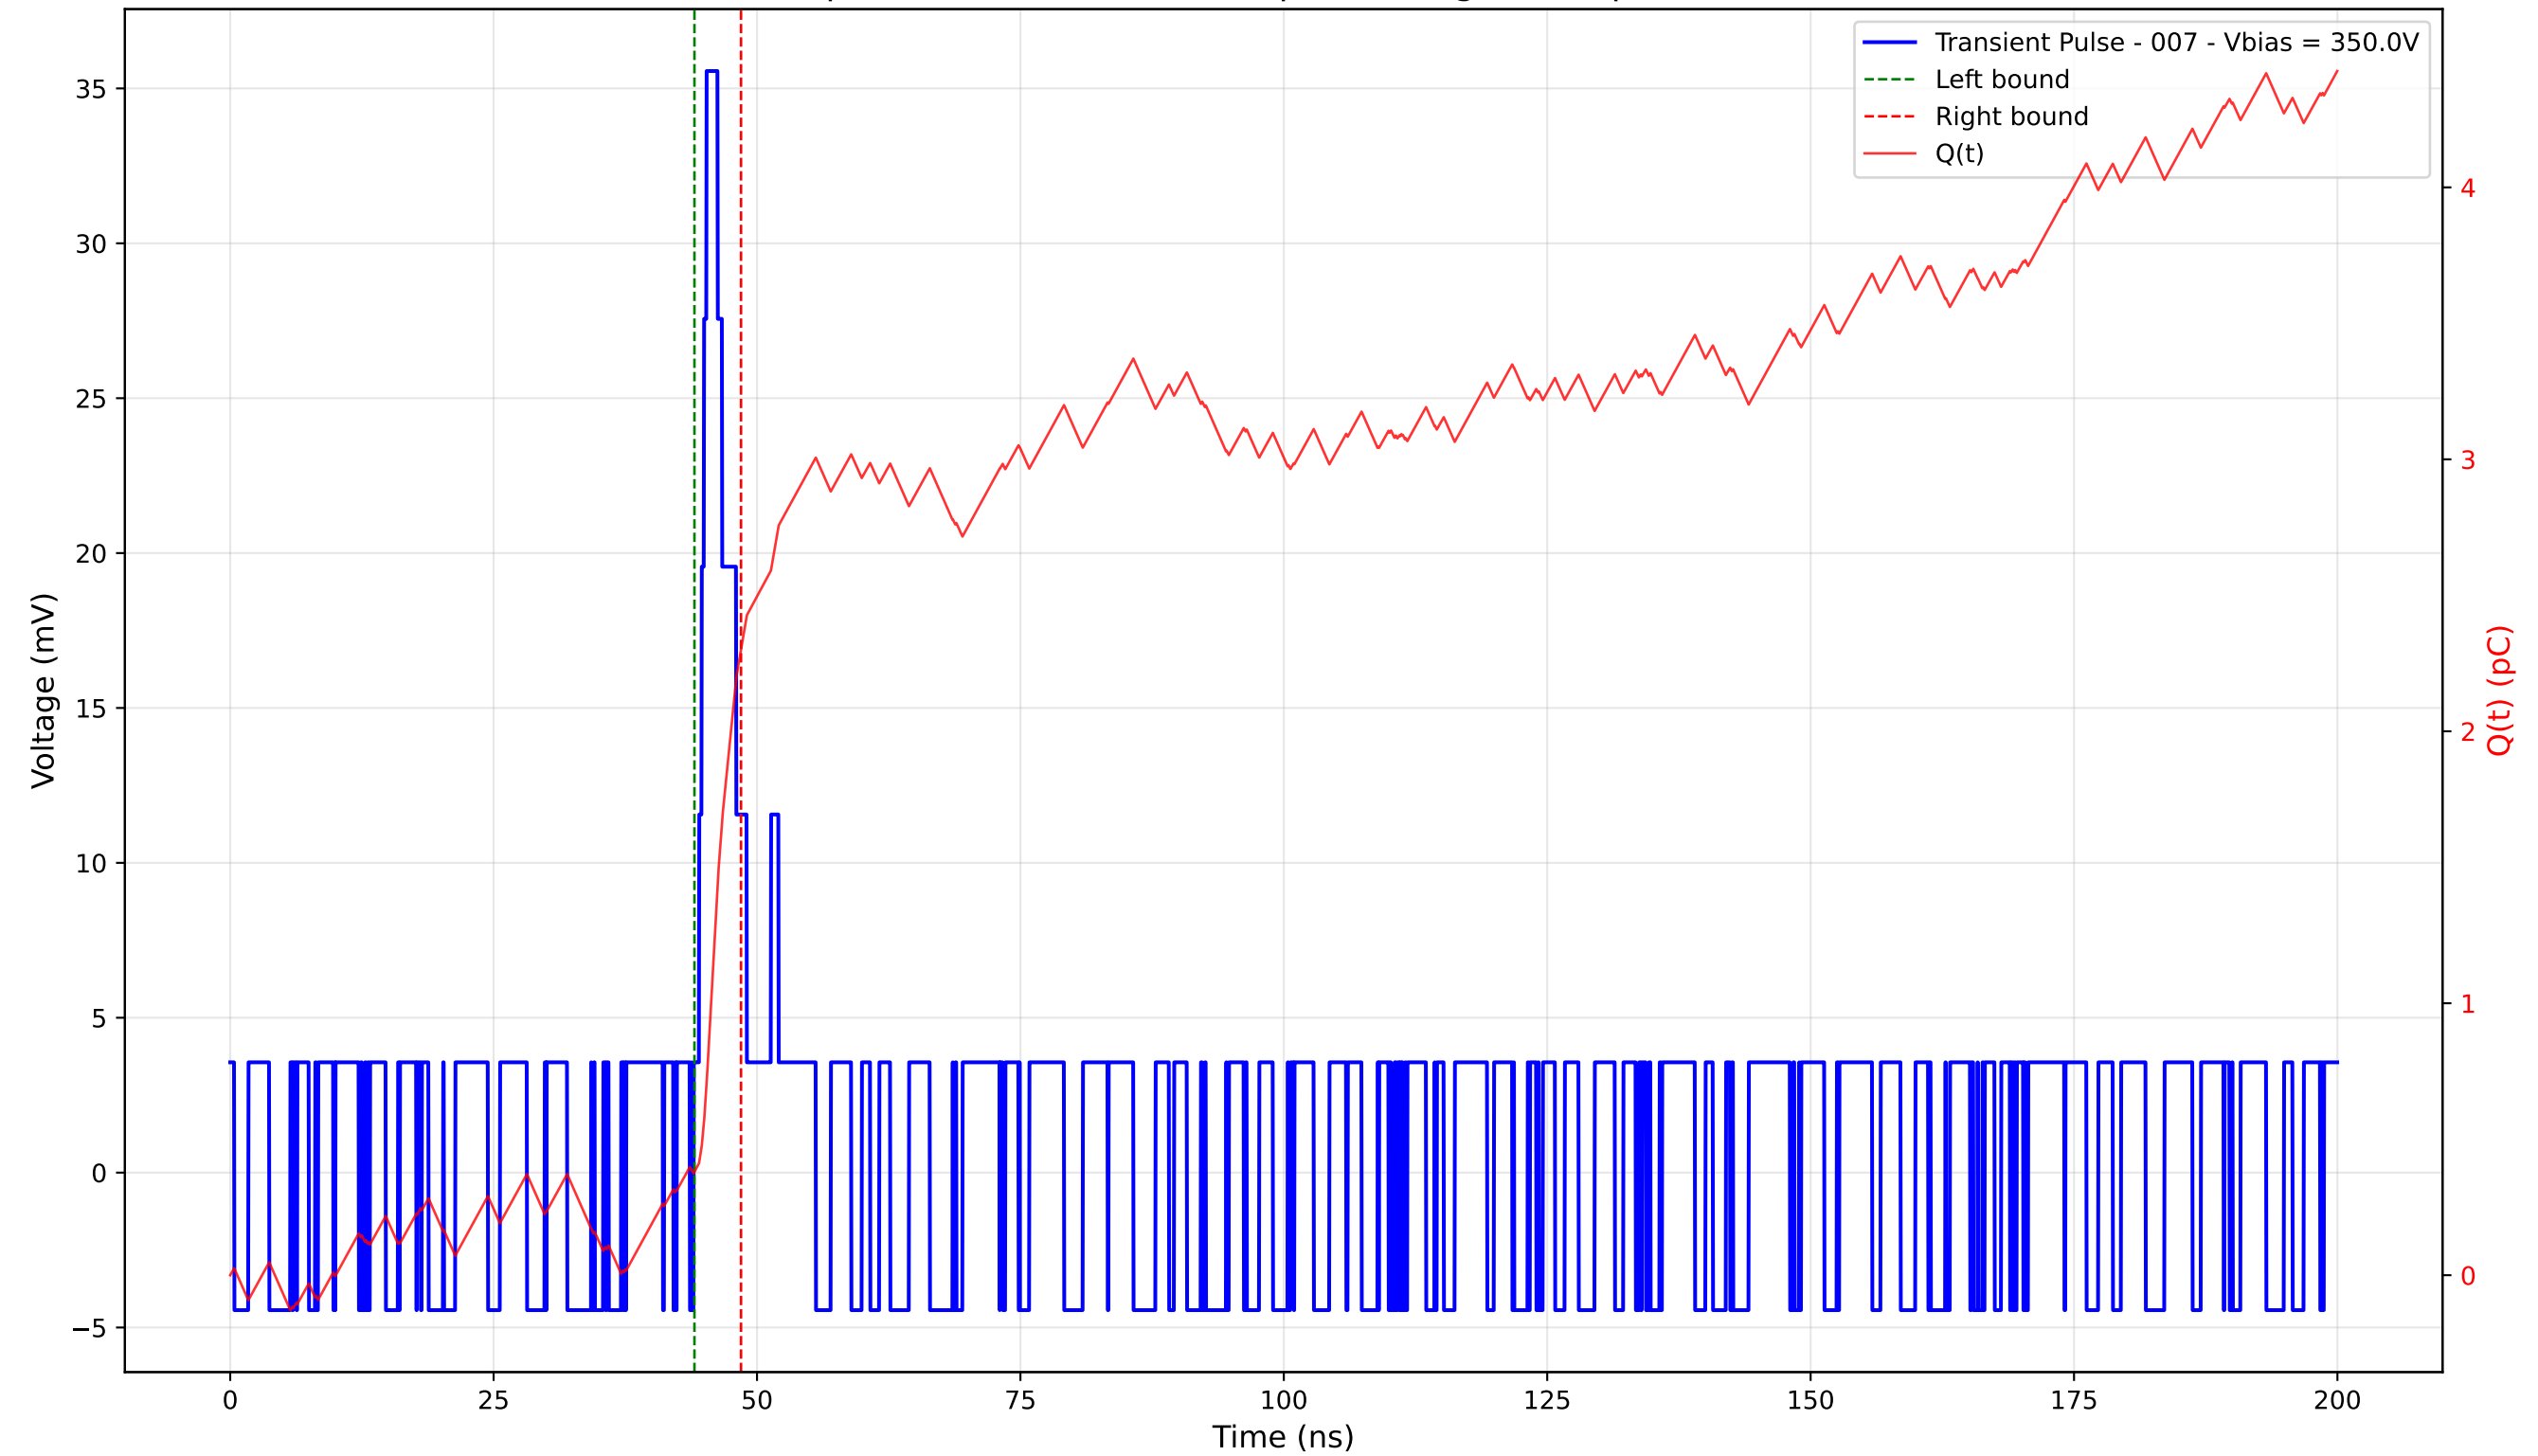


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.81 pC - Rise Time: 0.78 ns

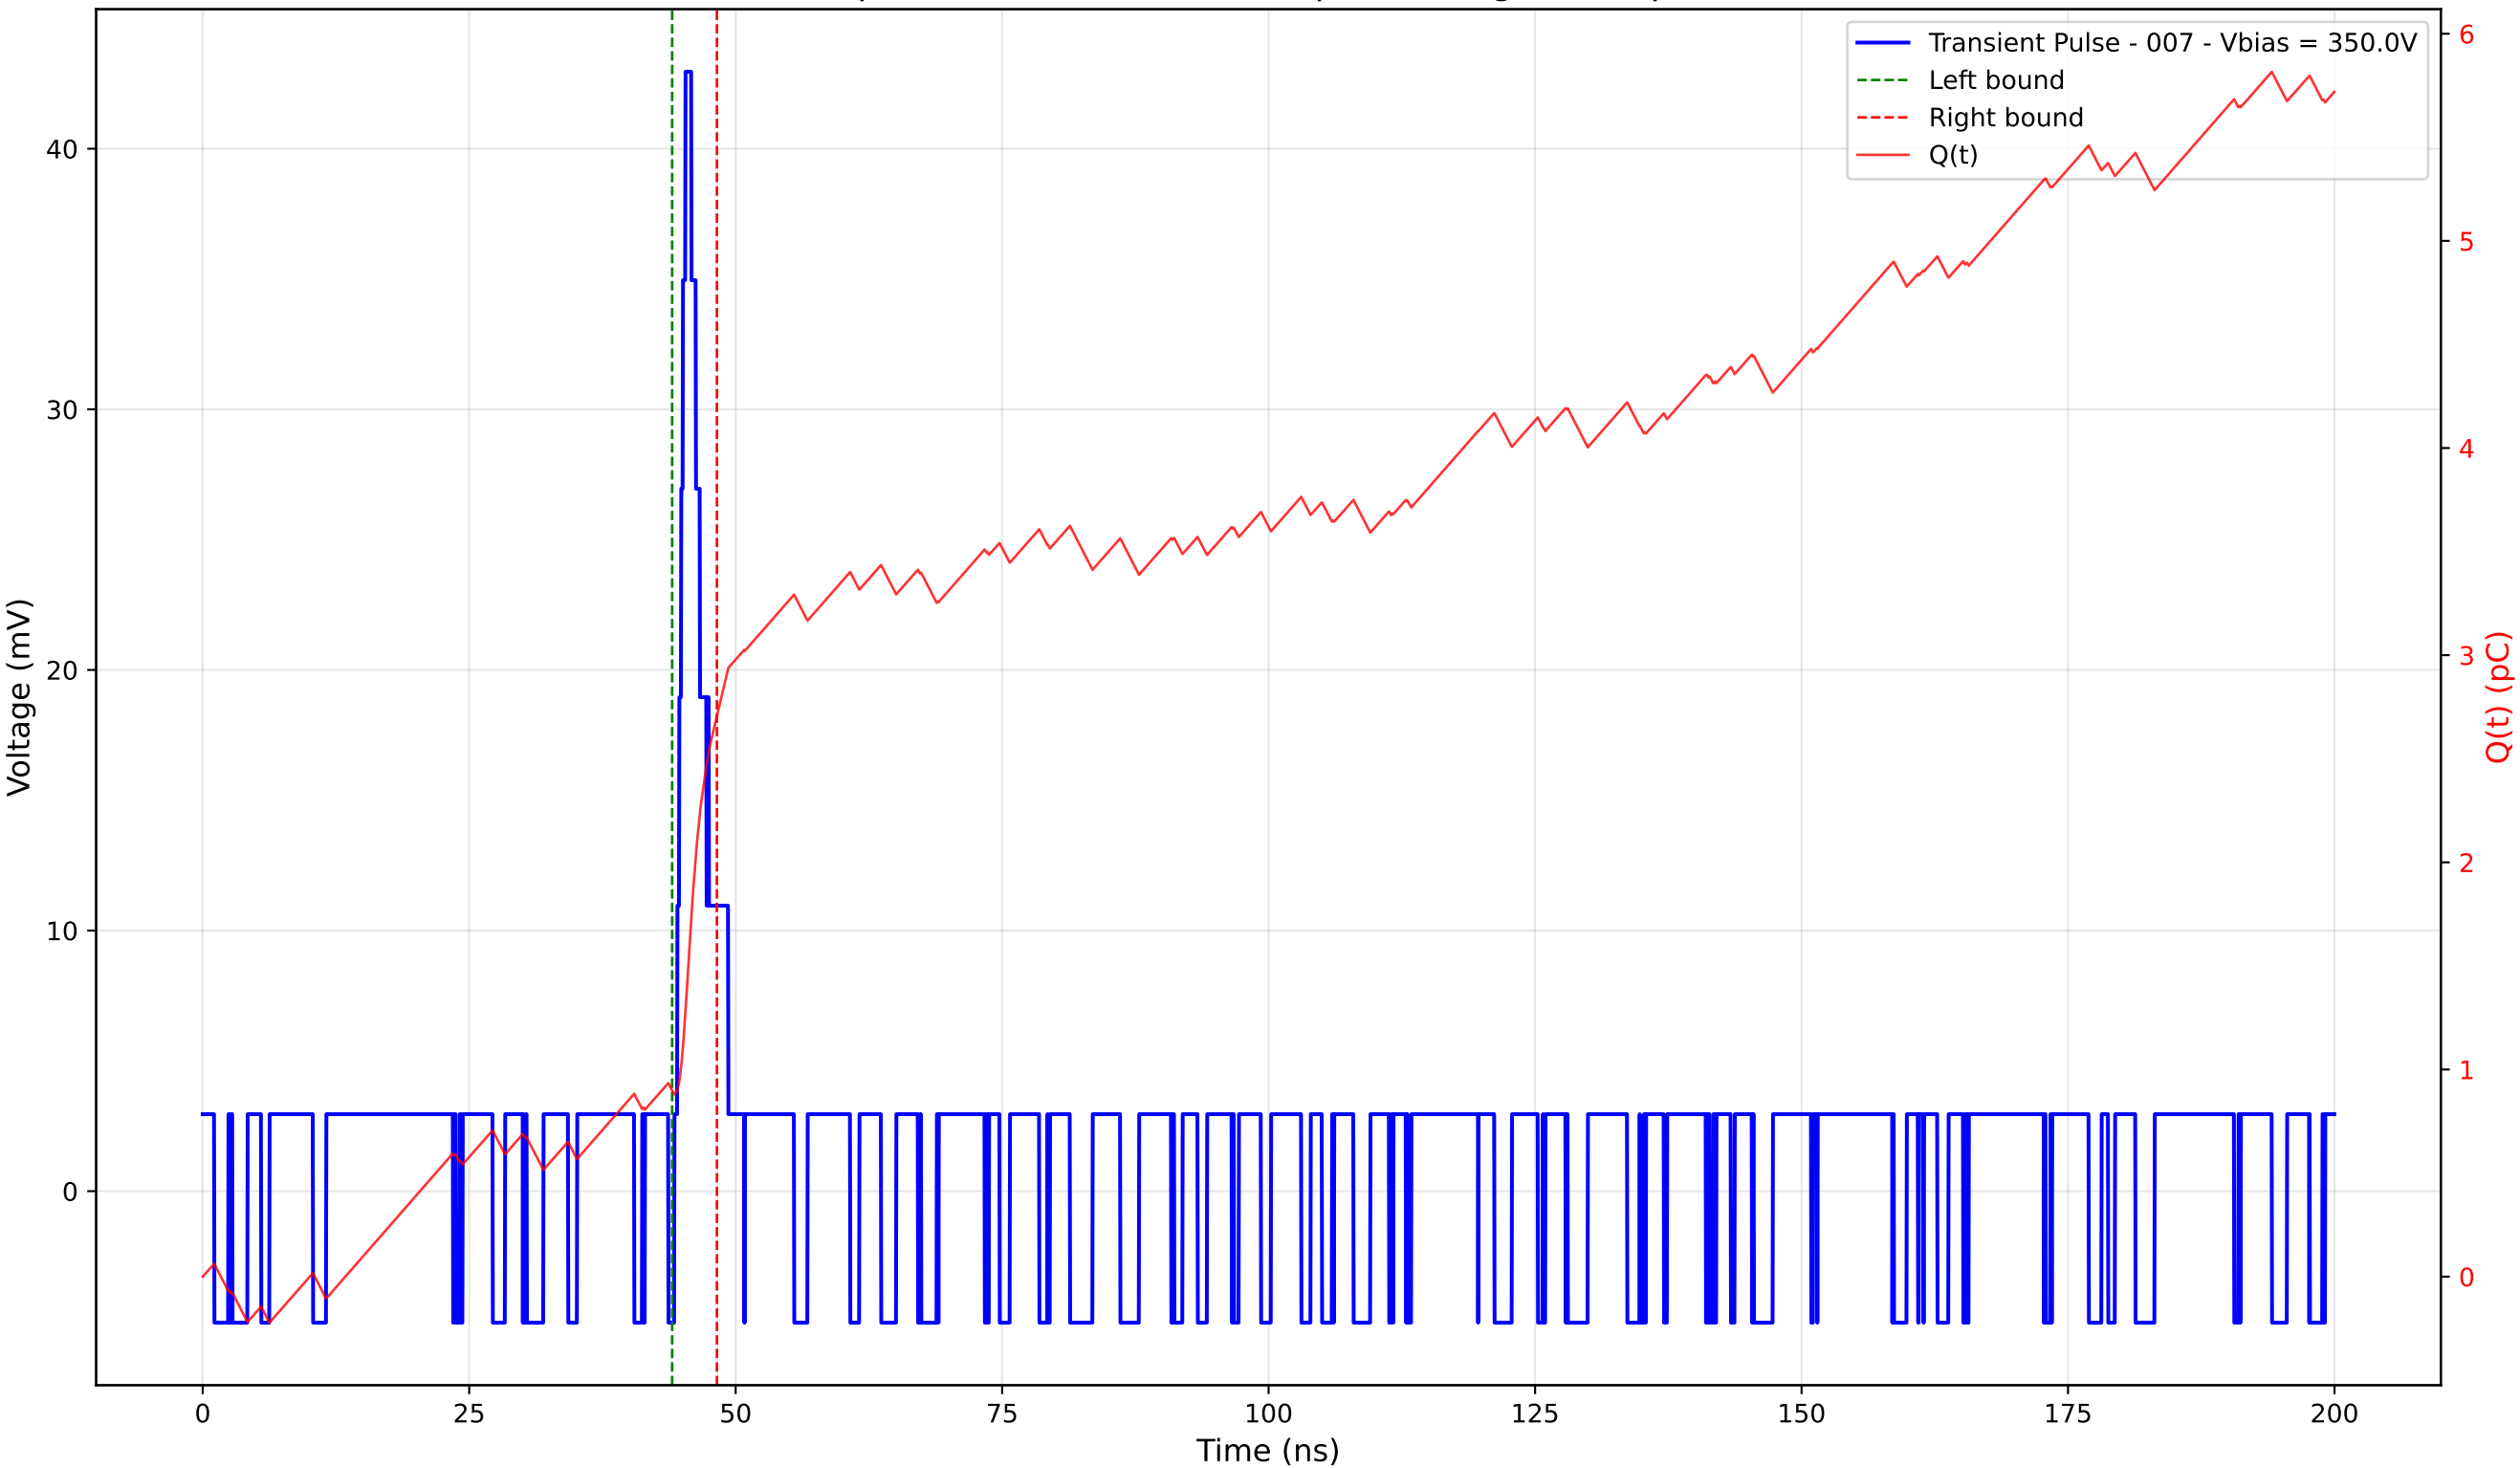


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.36 pC - Rise Time: 0.93 ns

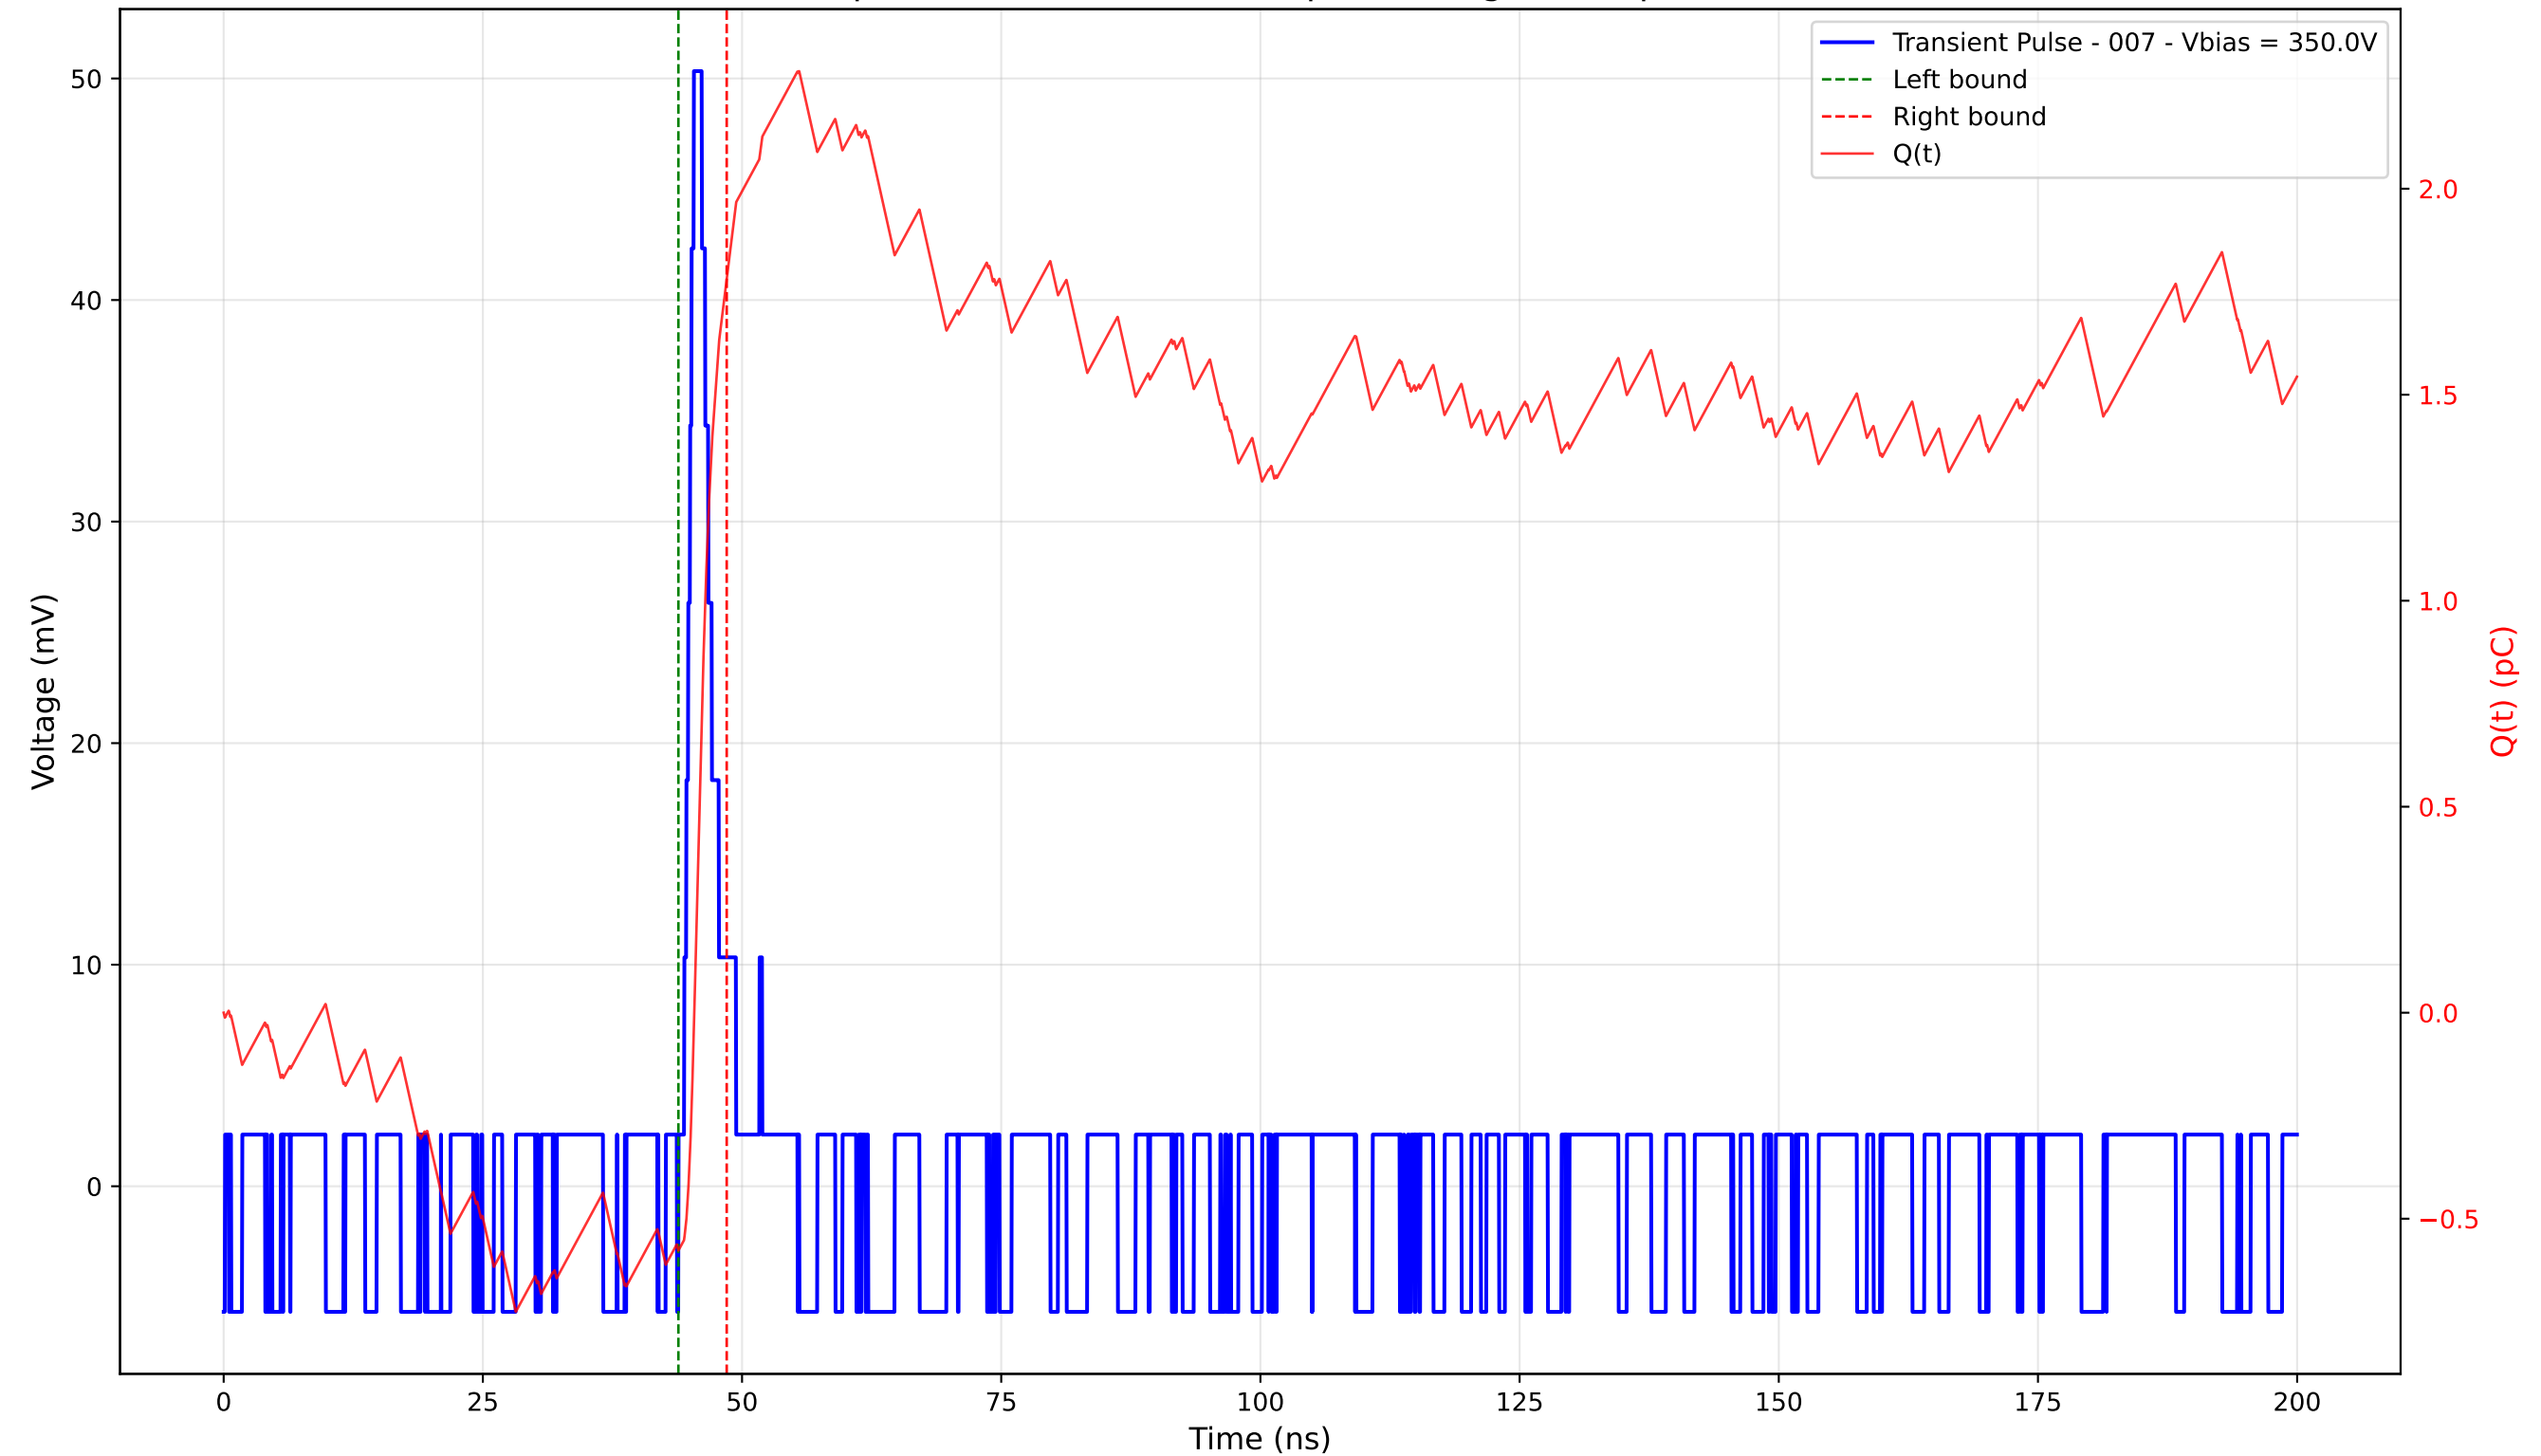


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 3.25 pC - Rise Time: 1.19 ns

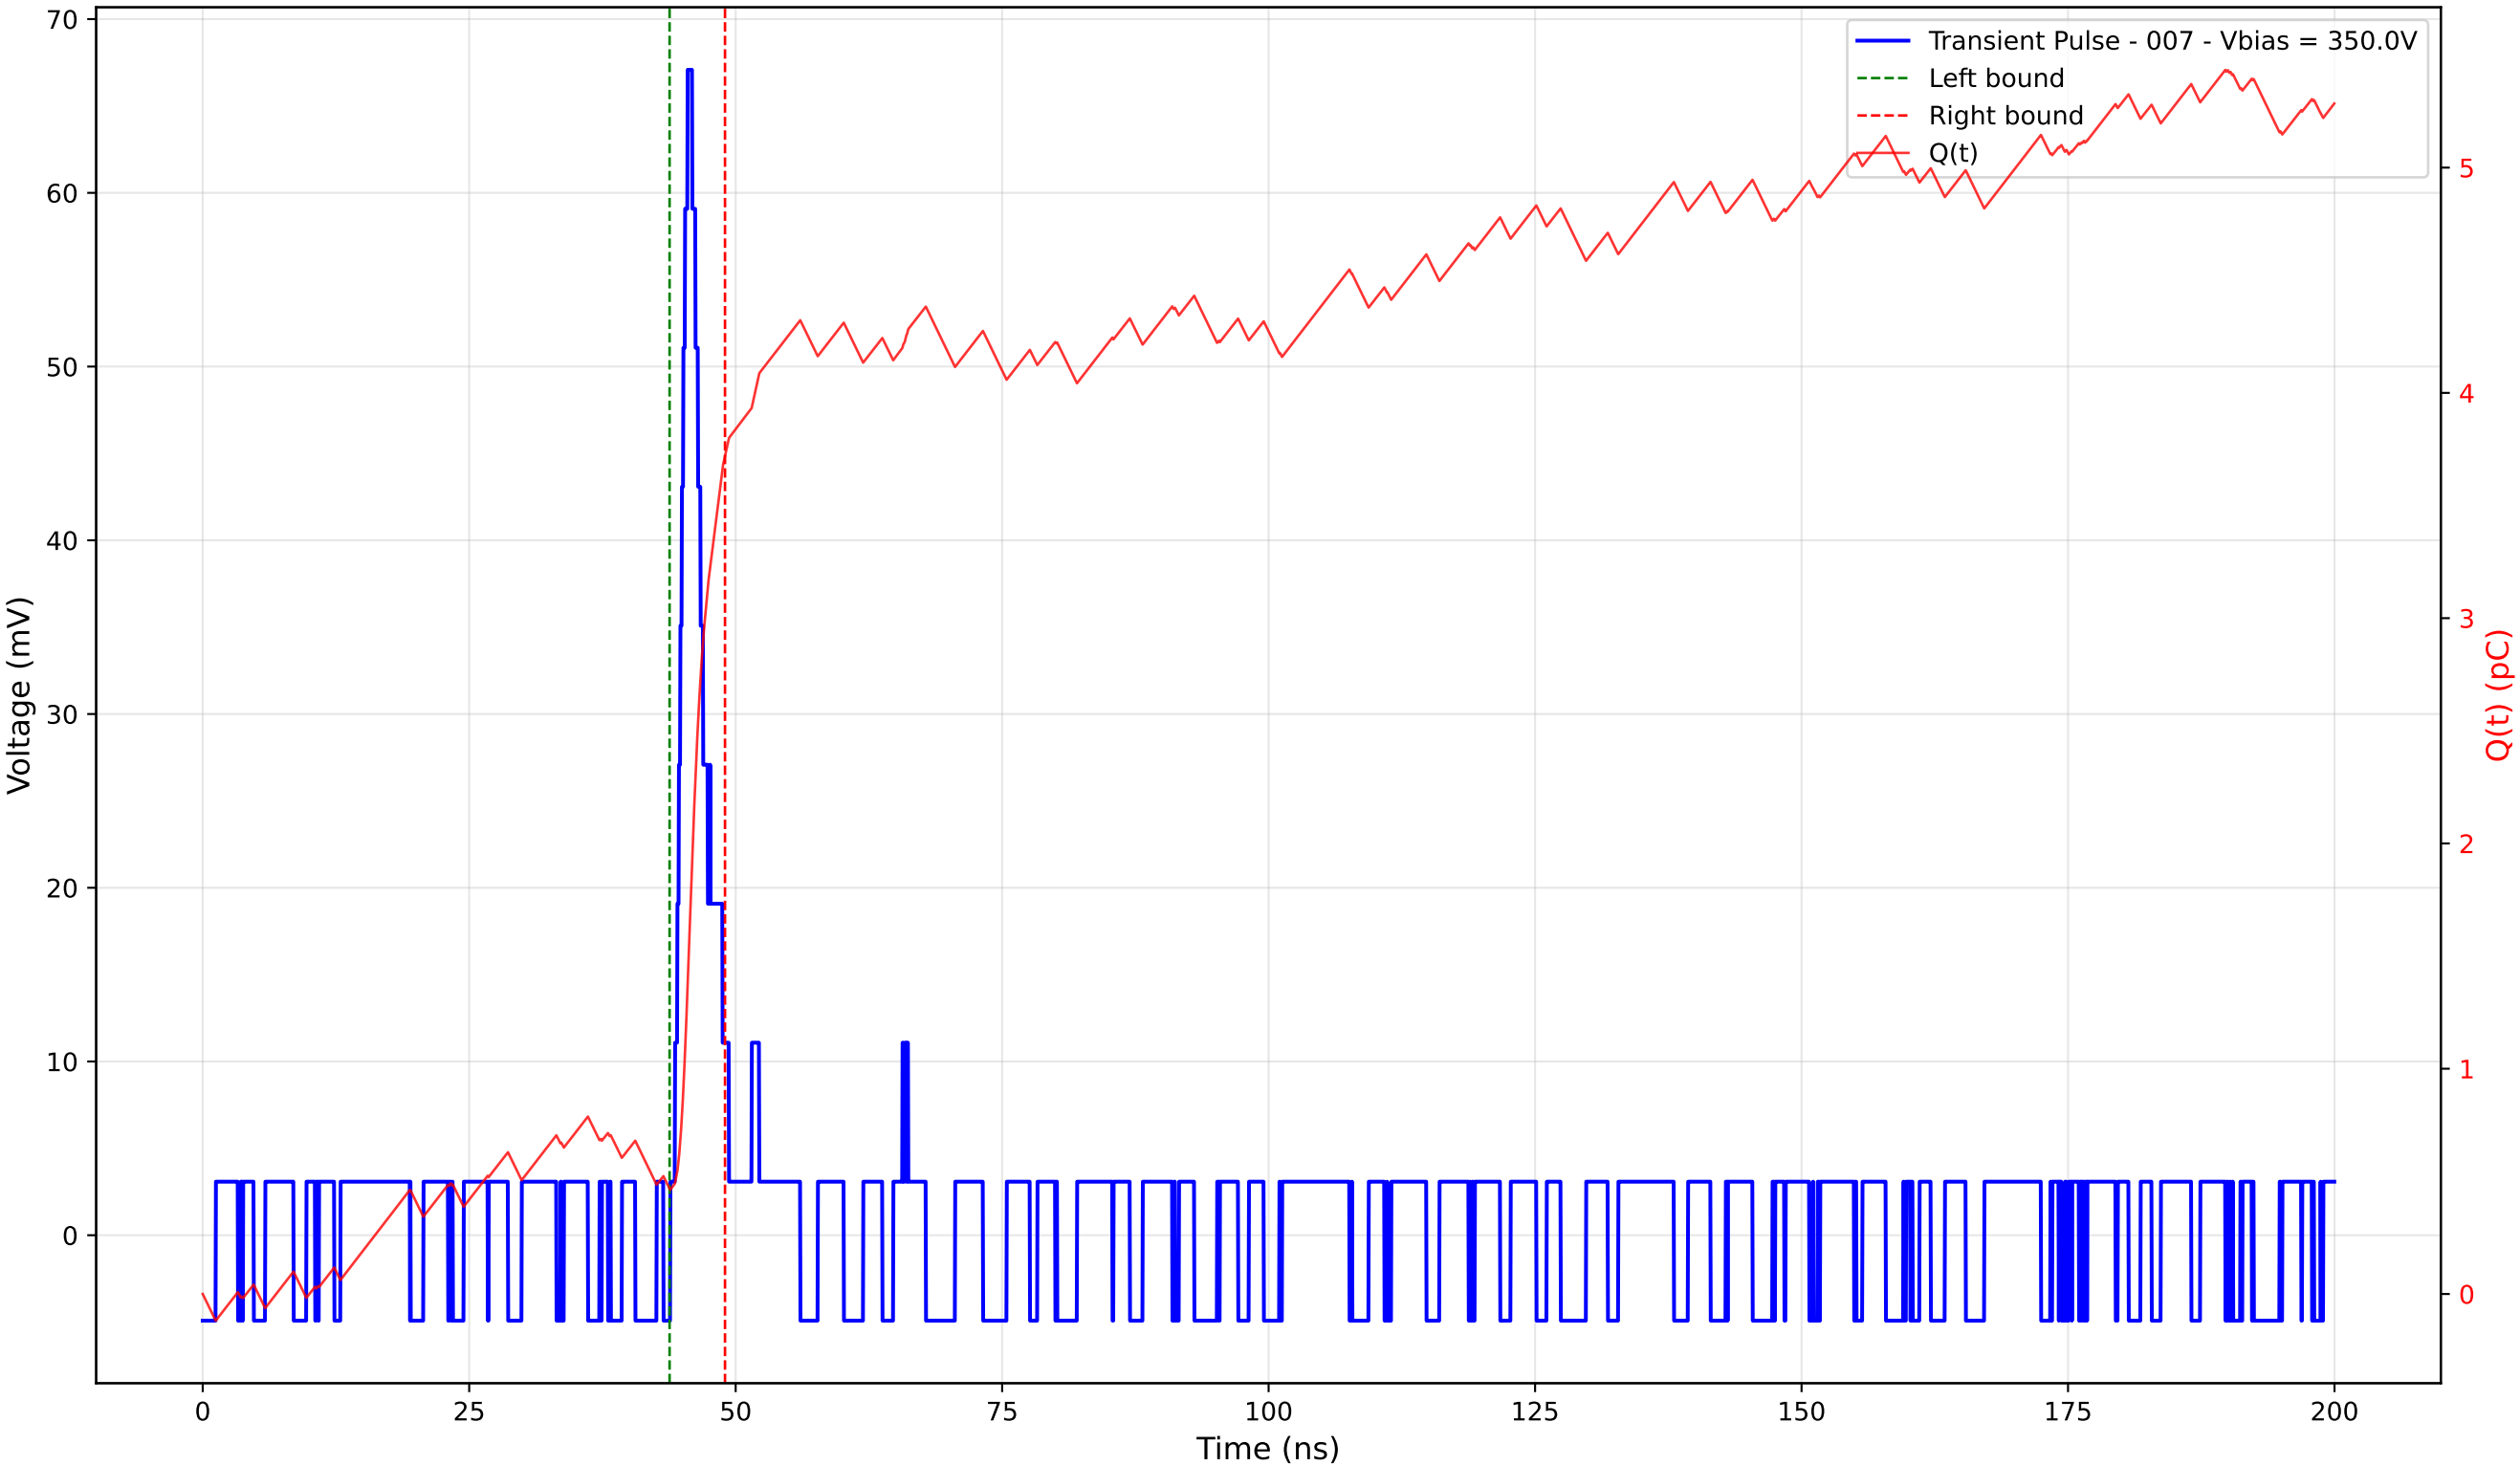


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.53 pC - Rise Time: 1.07 ns

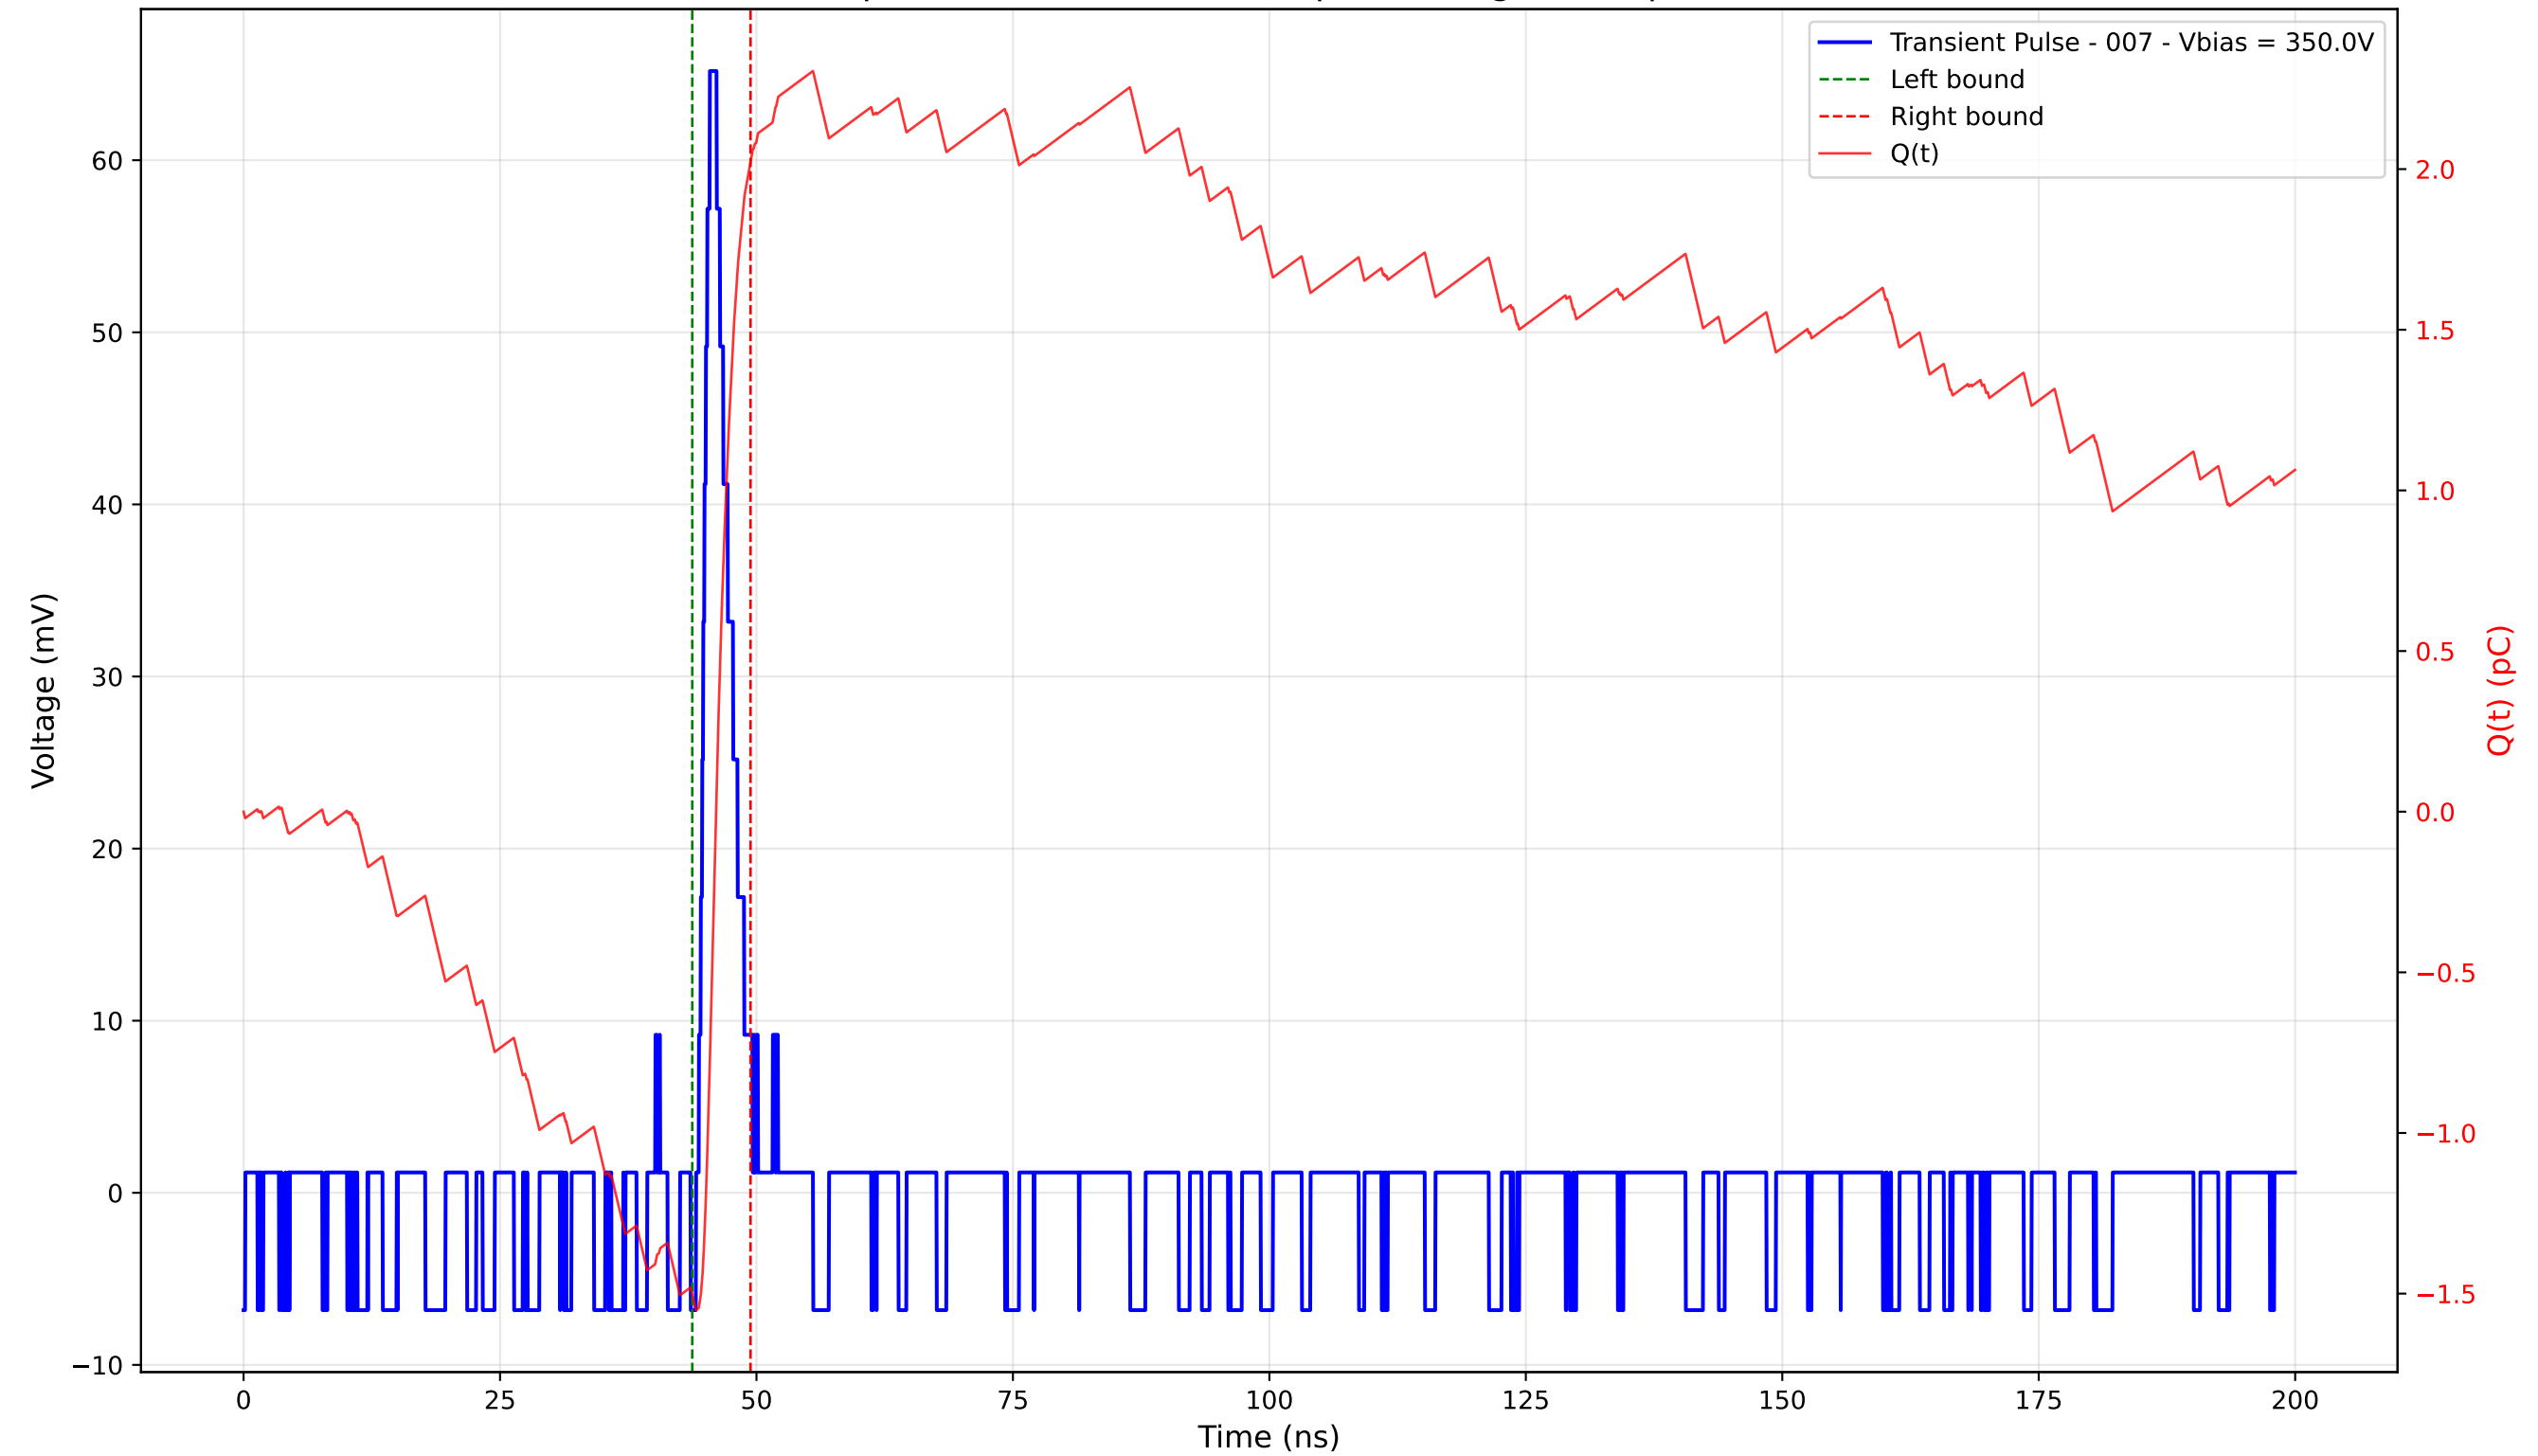


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.26 pC - Rise Time: 0.99 ns

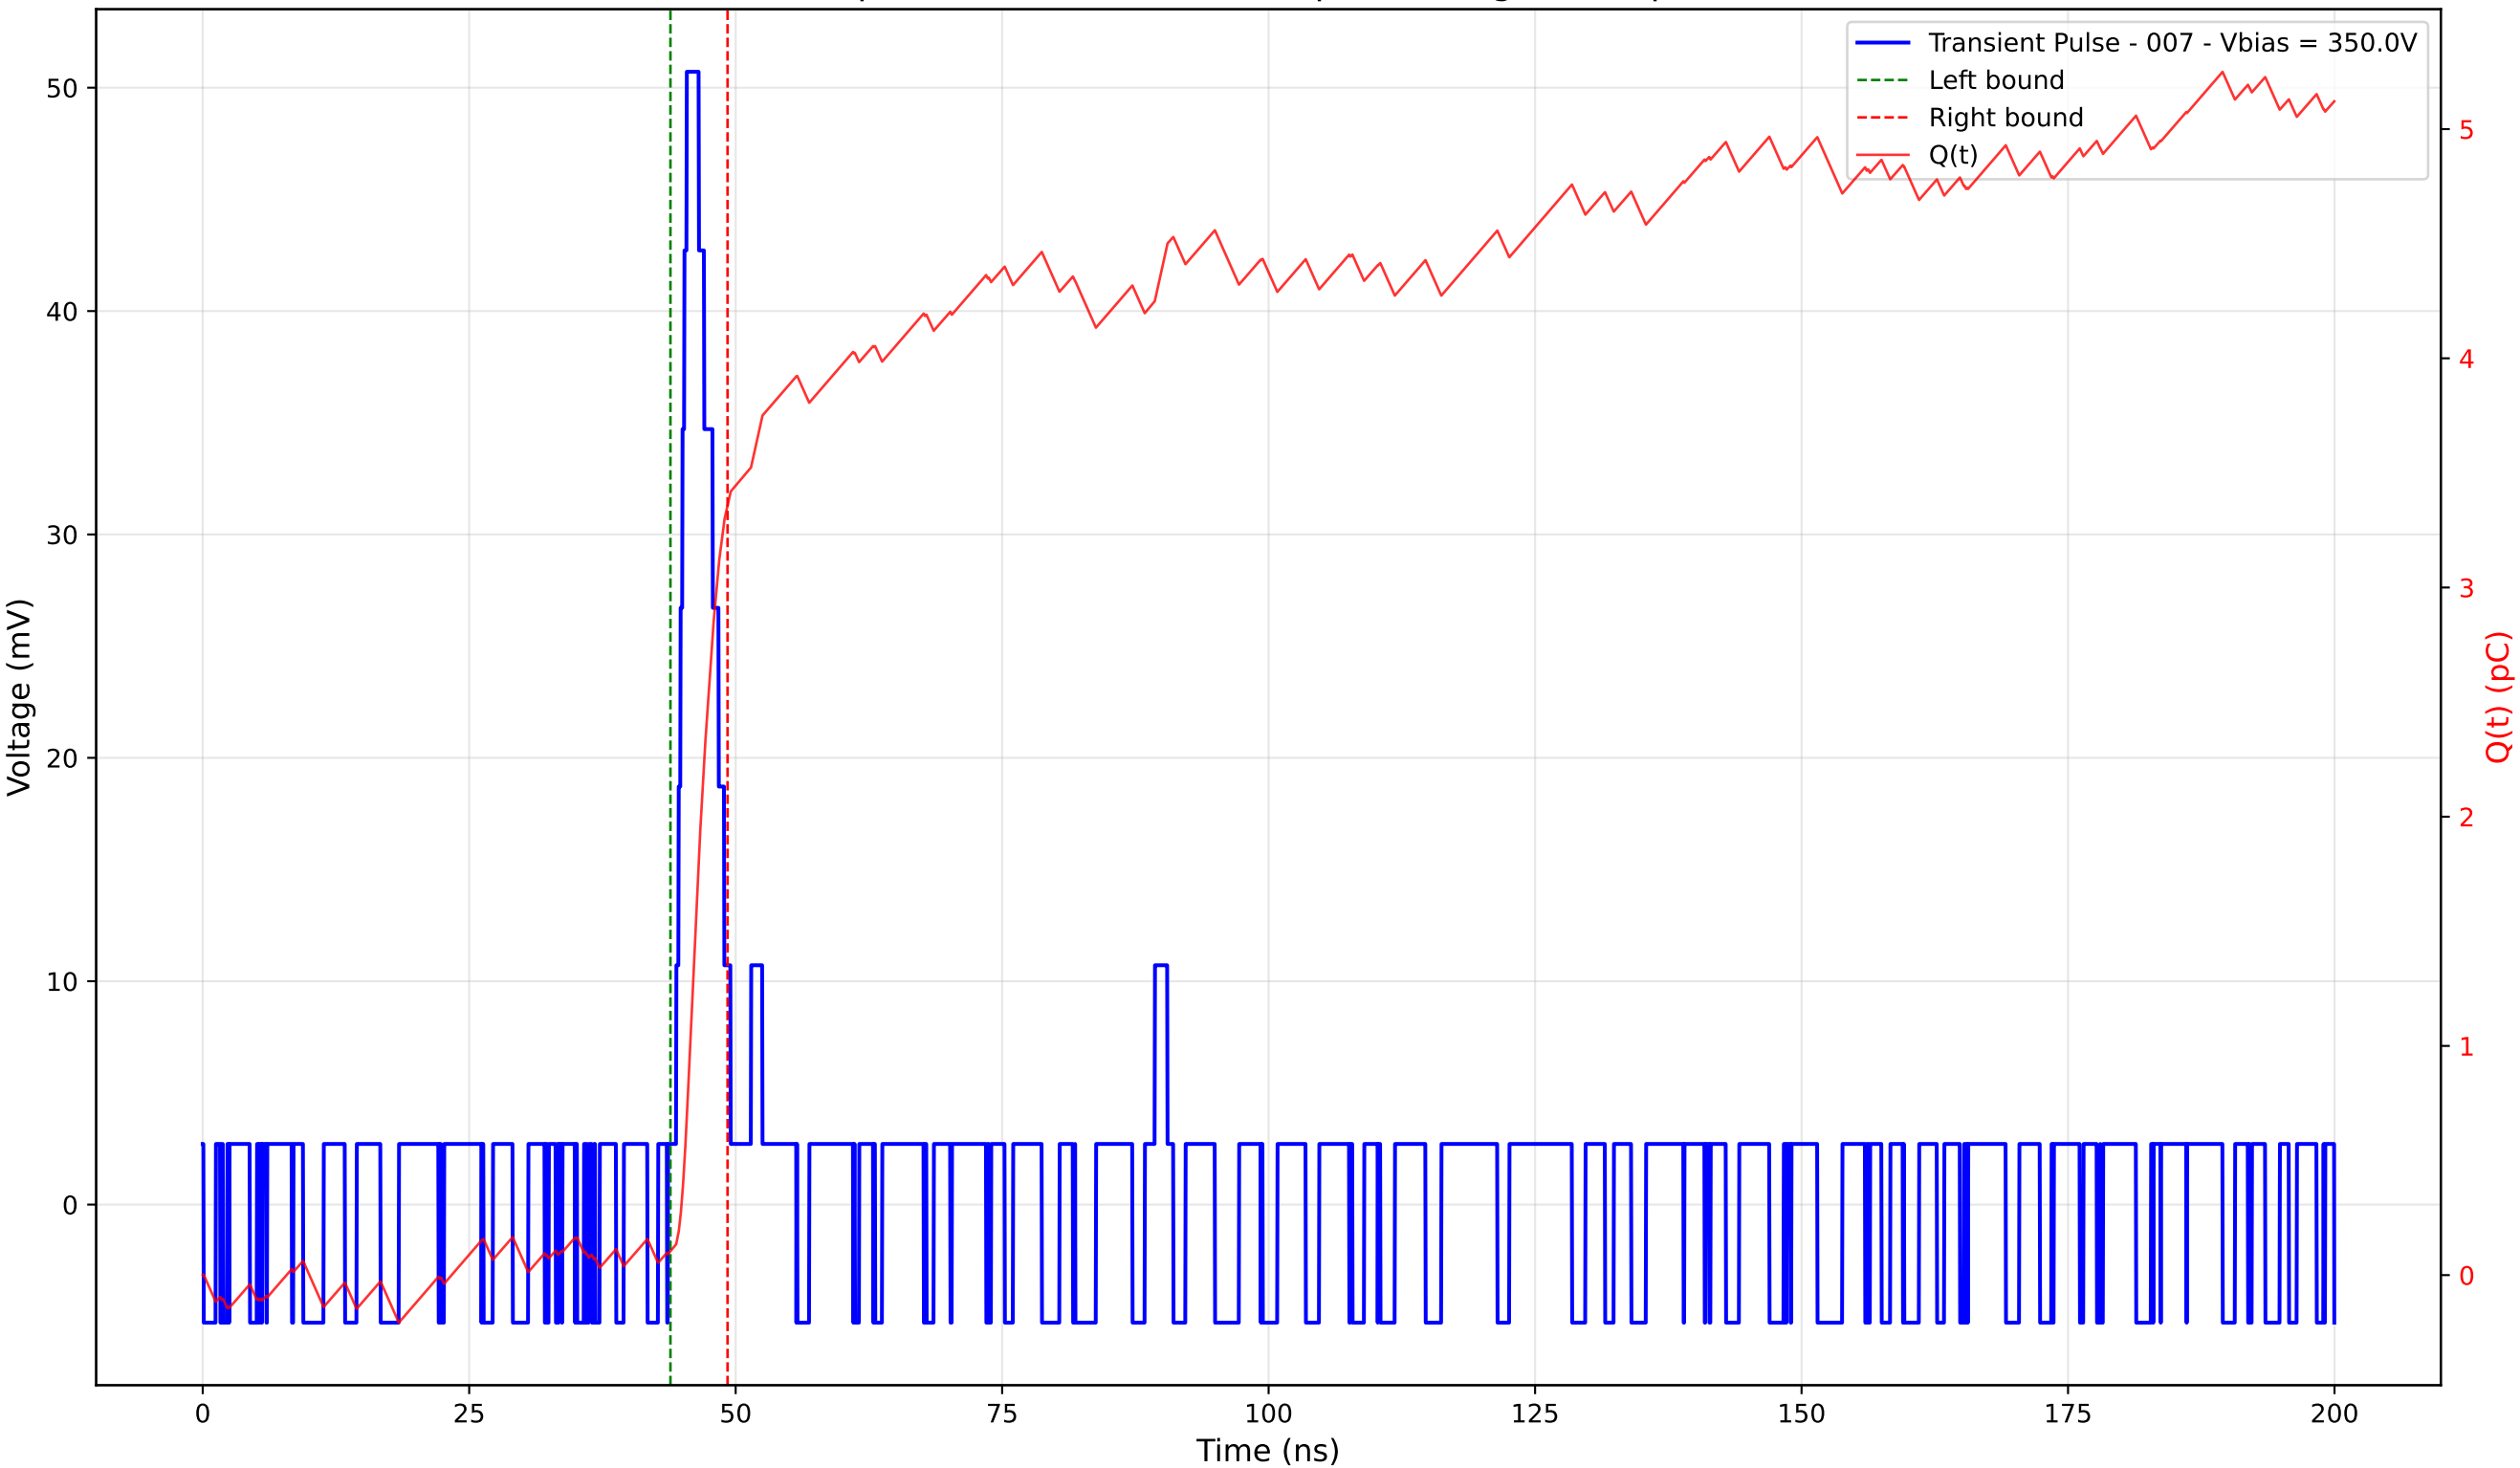


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 1.86 pC - Rise Time: 0.00 ns (N/A)

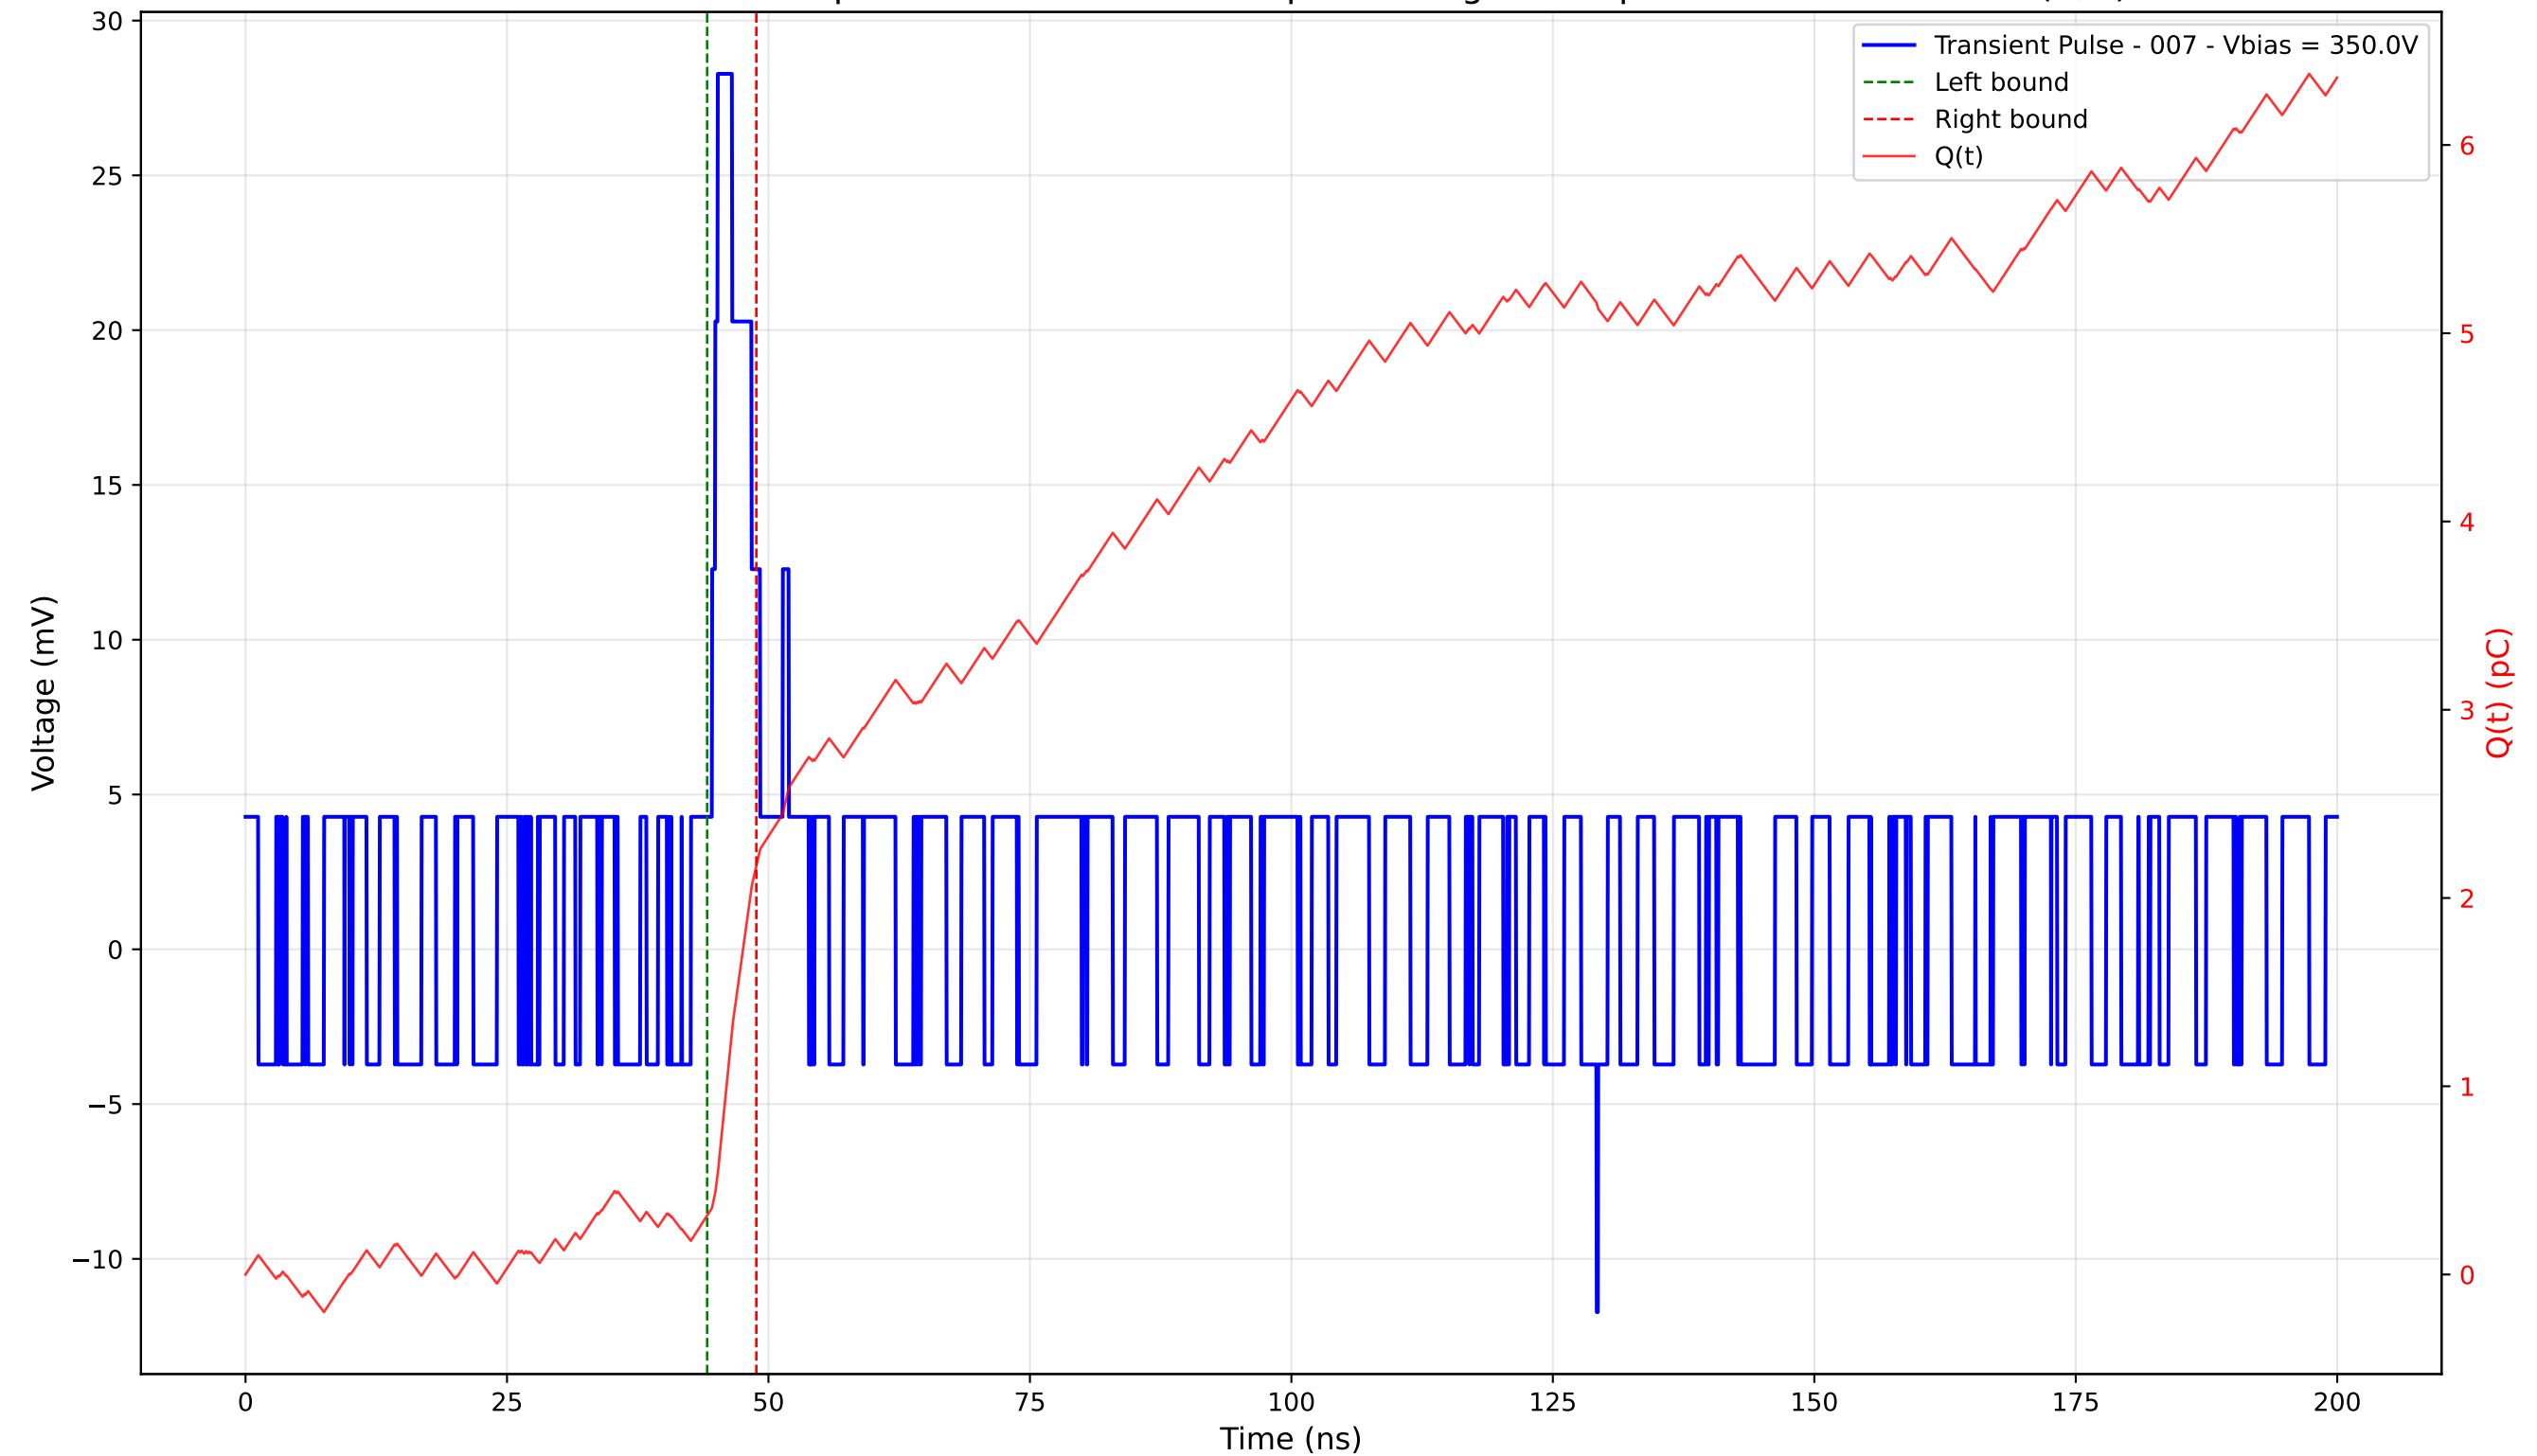


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 0.59 pC - Rise Time: 0.50 ns

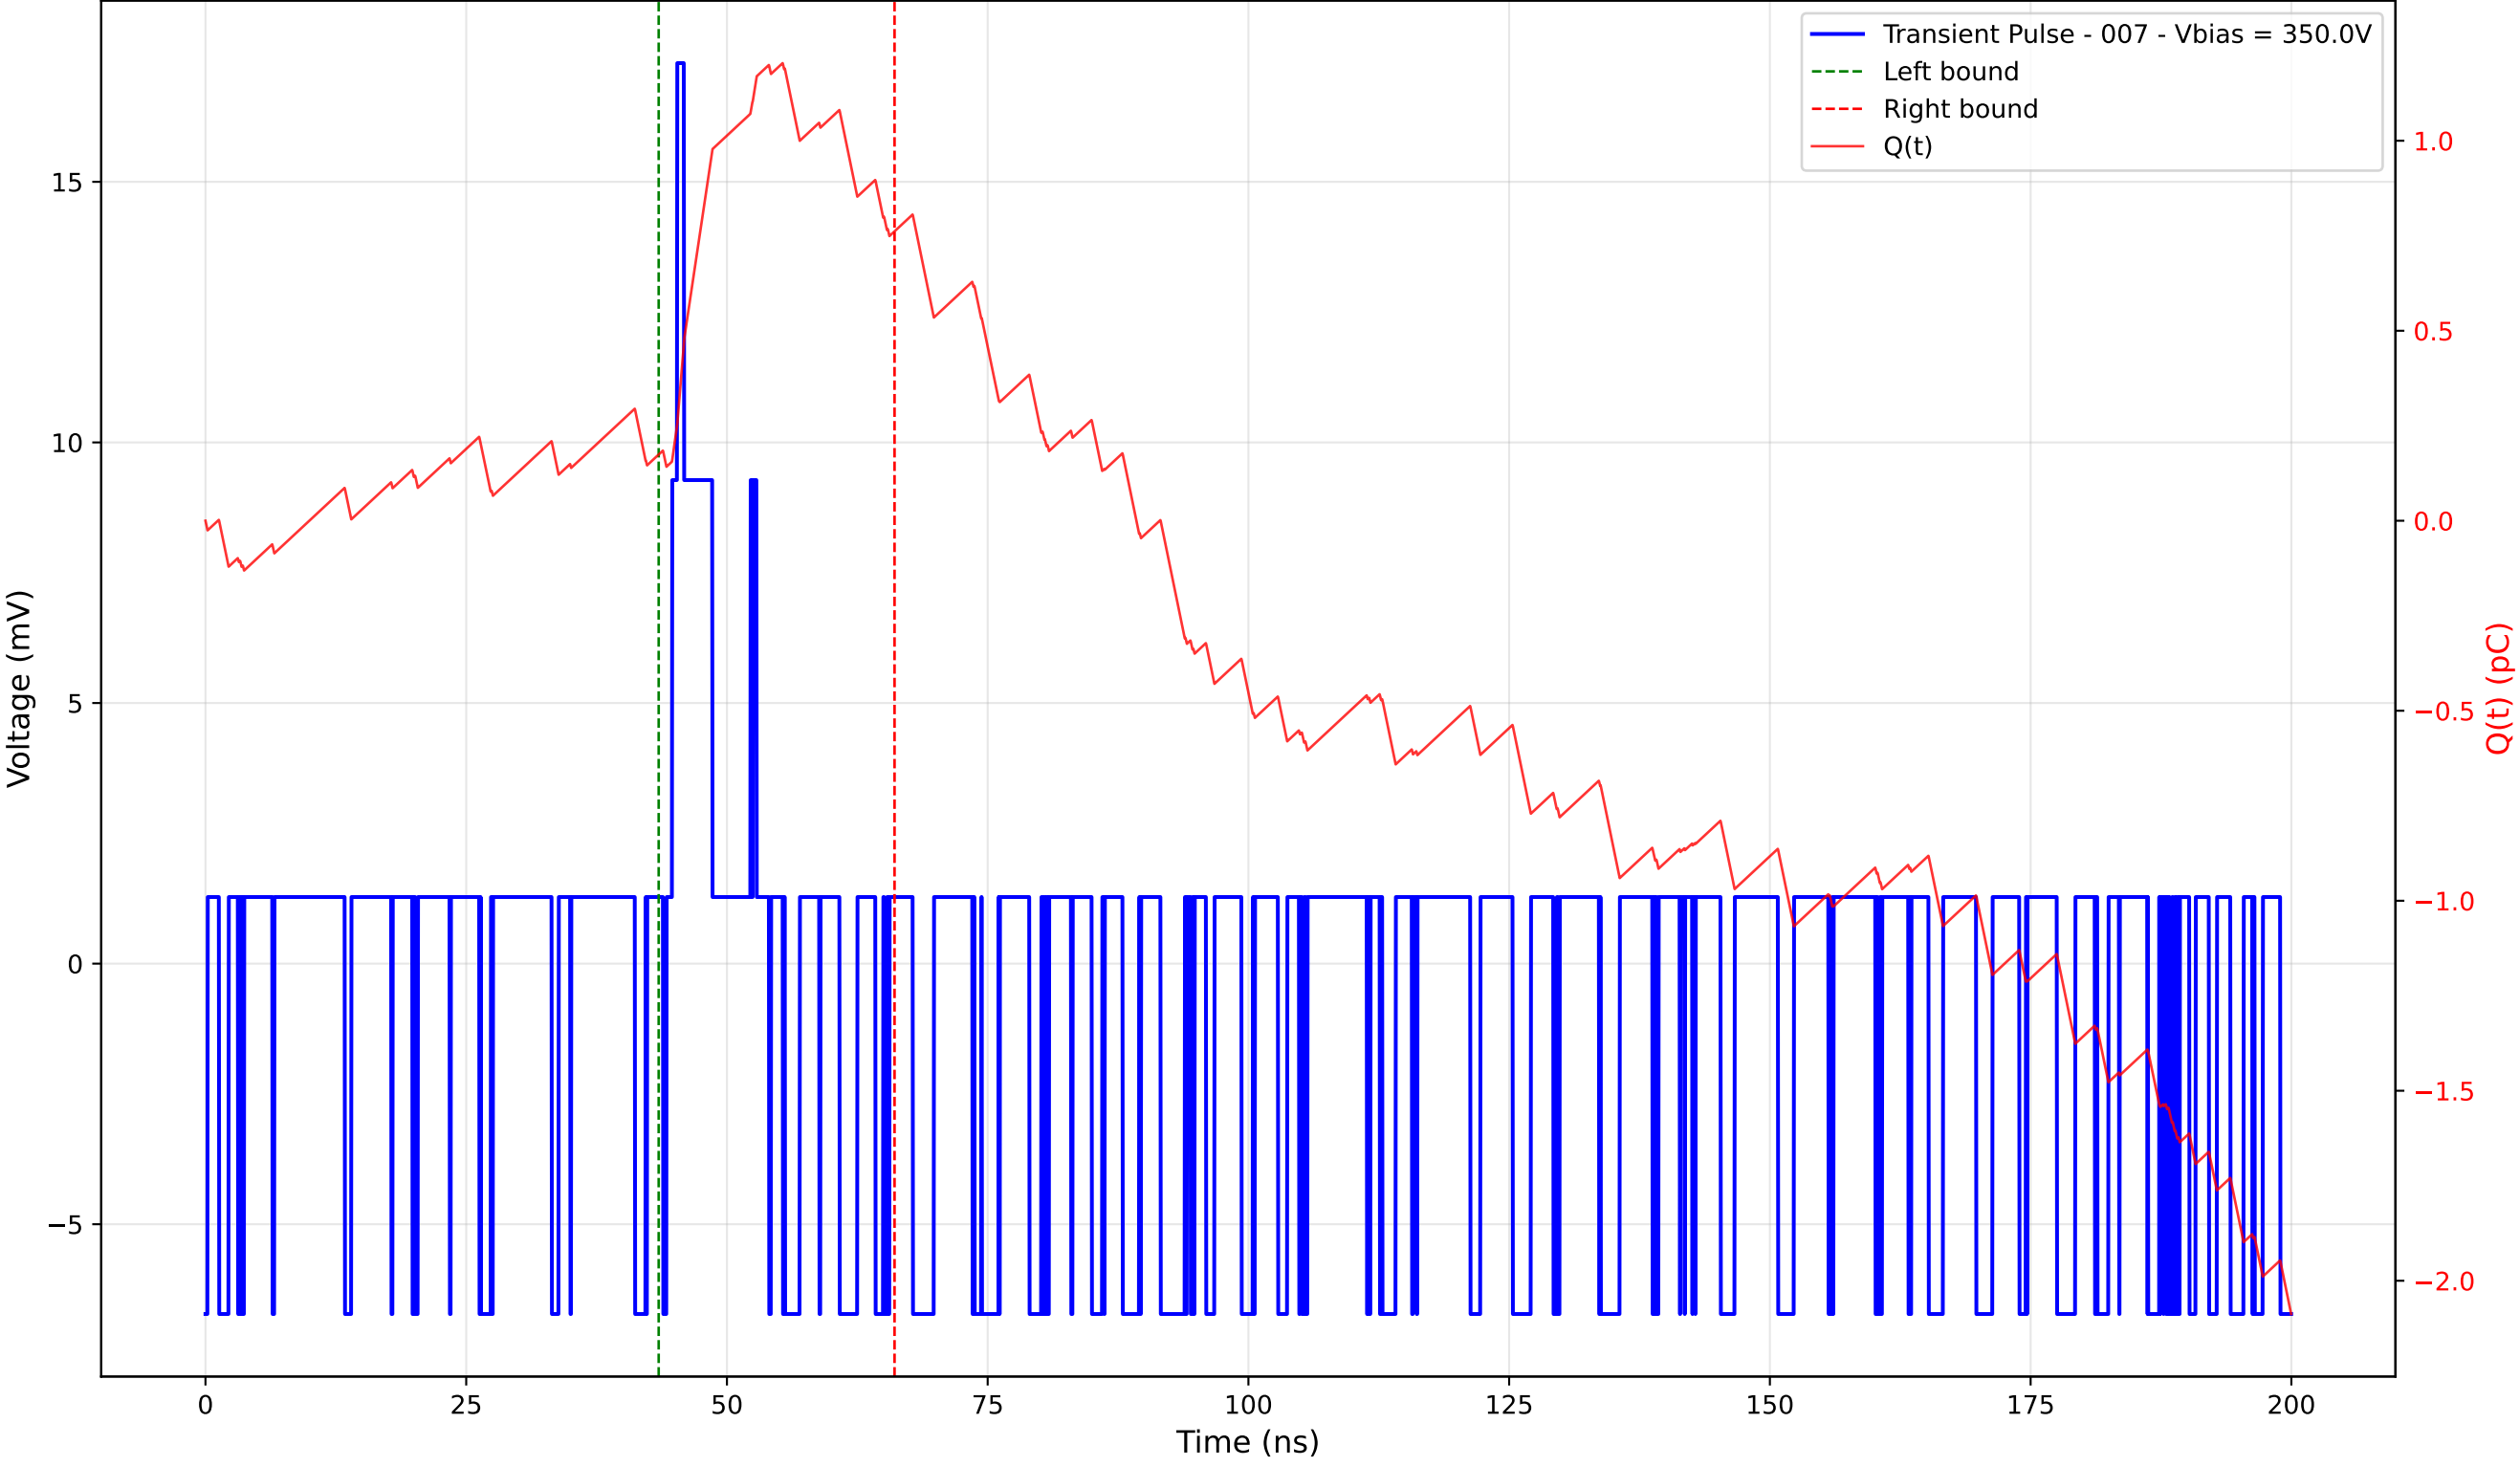


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 0.98 pC - Rise Time: 0.50 ns

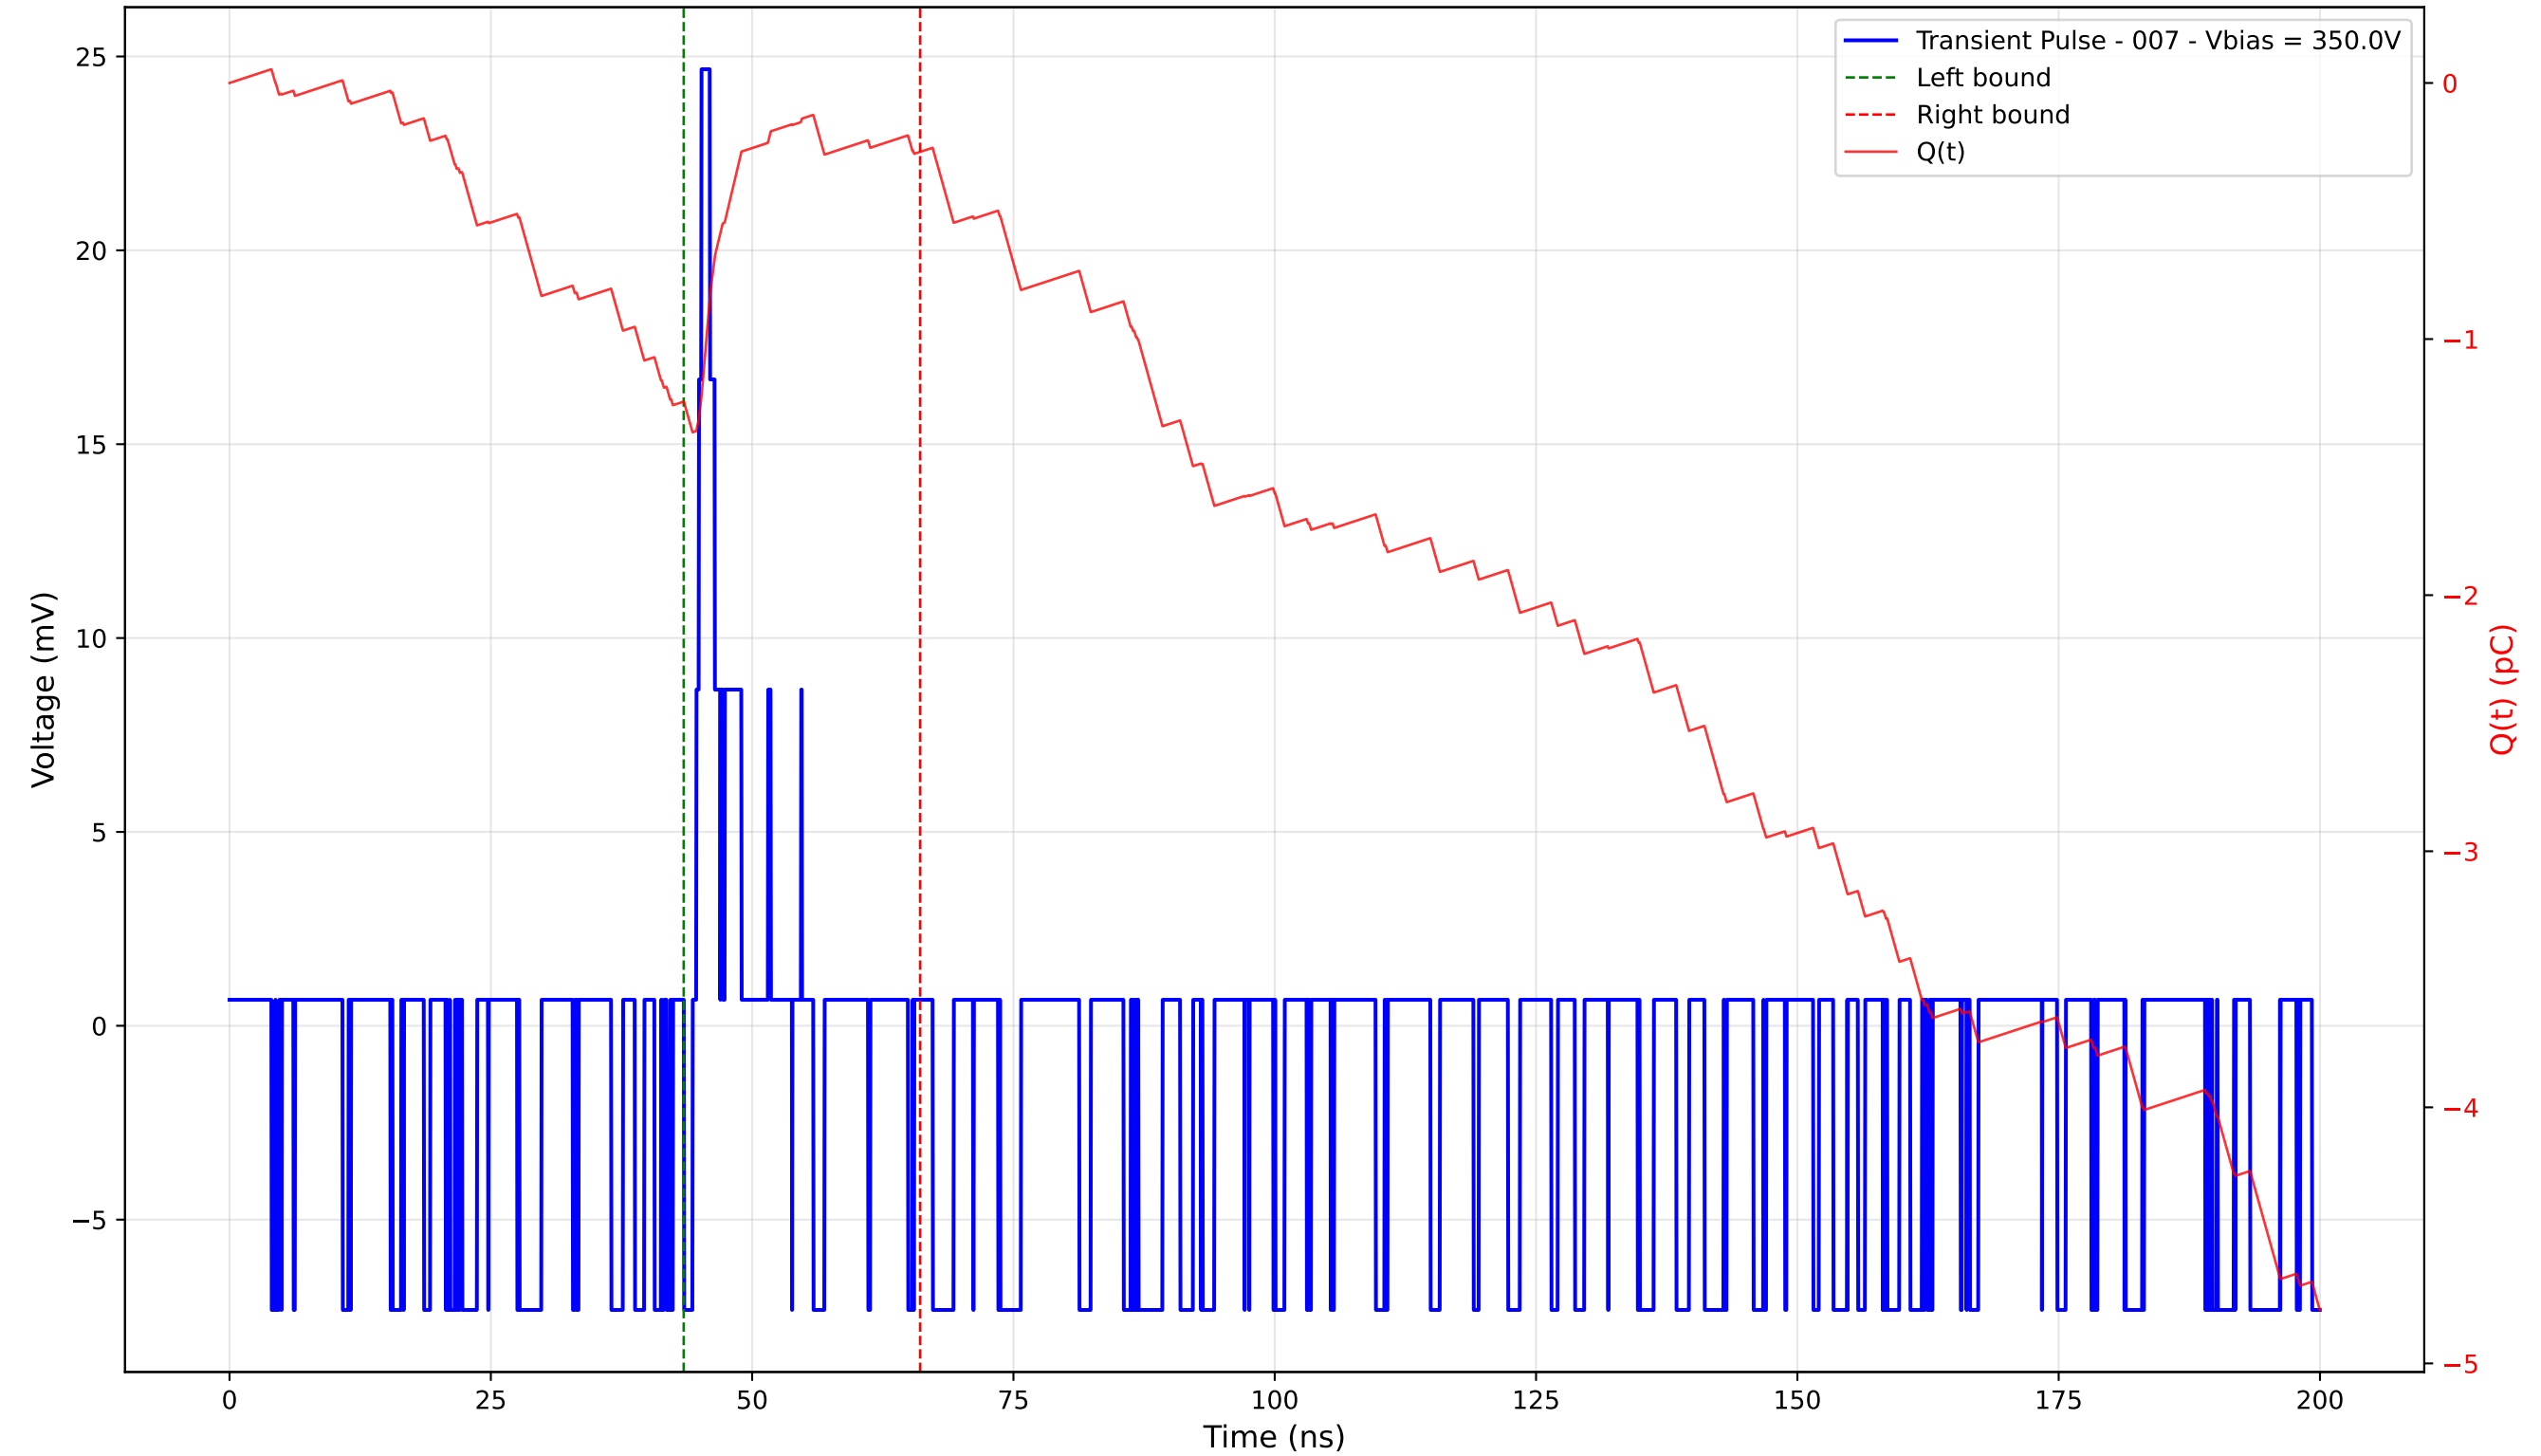


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 2.39 pC - Rise Time: 1.04 ns

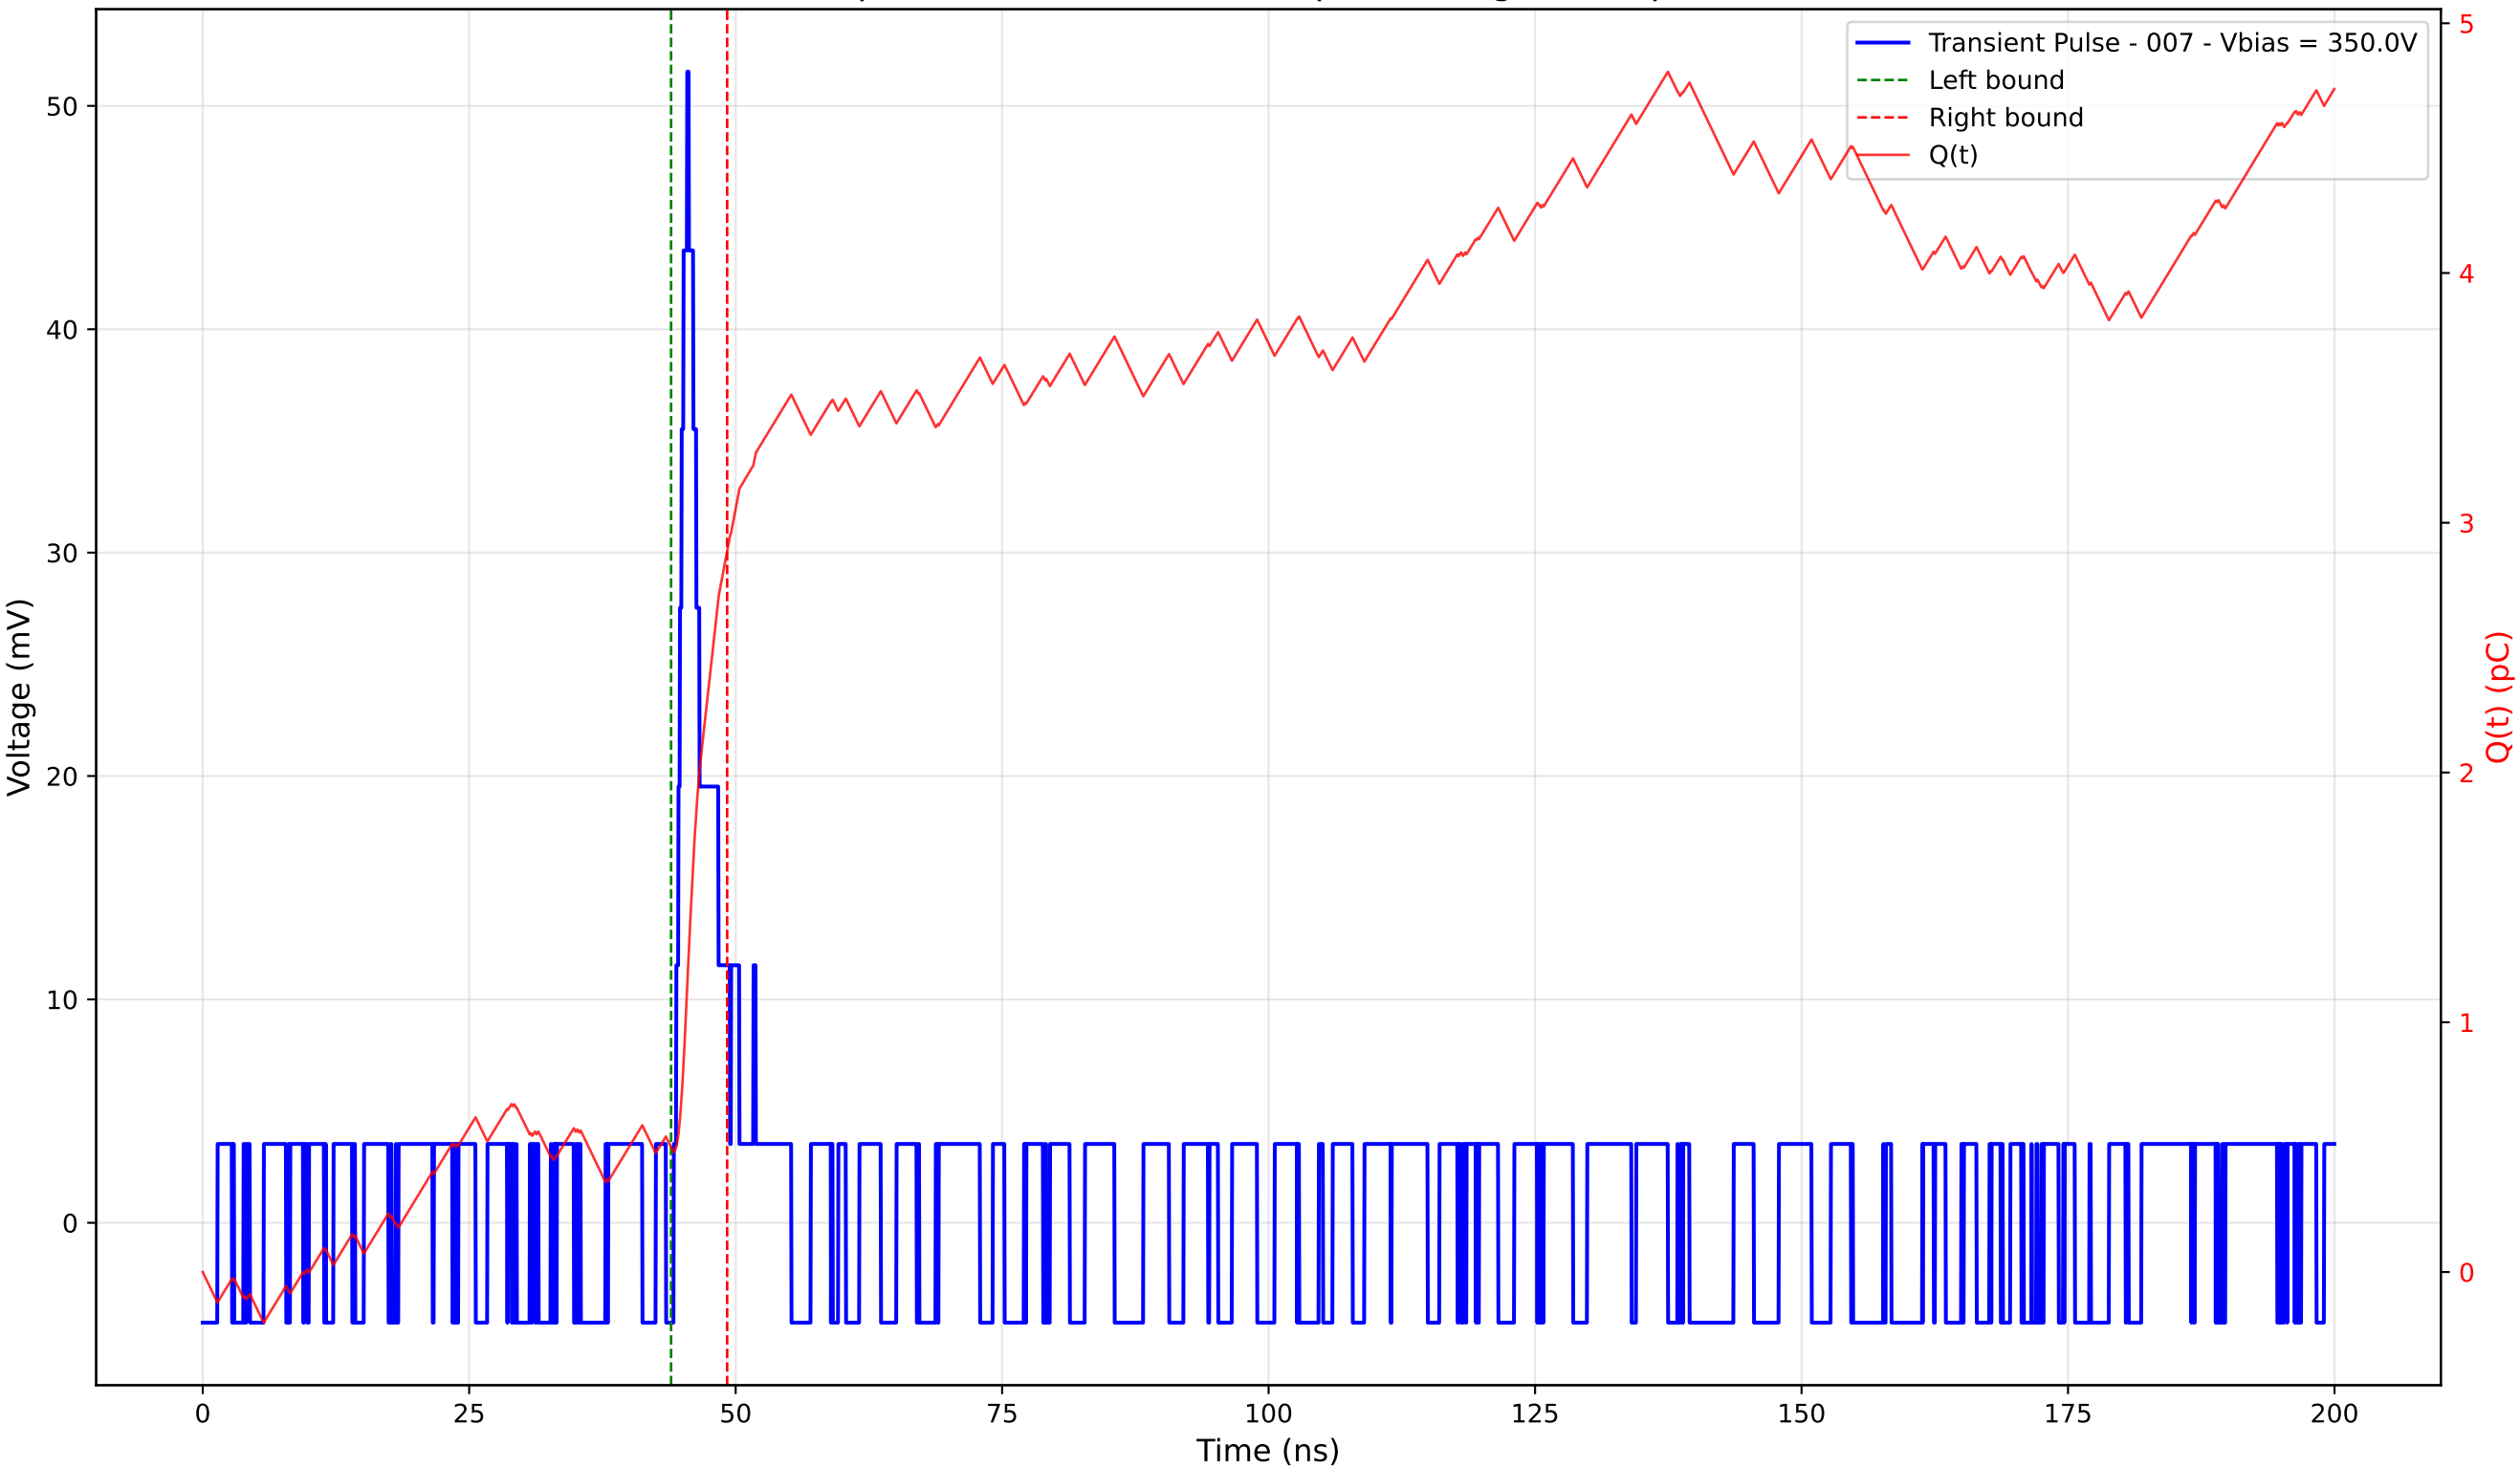


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 4.69 pC - Rise Time: 0.87 ns

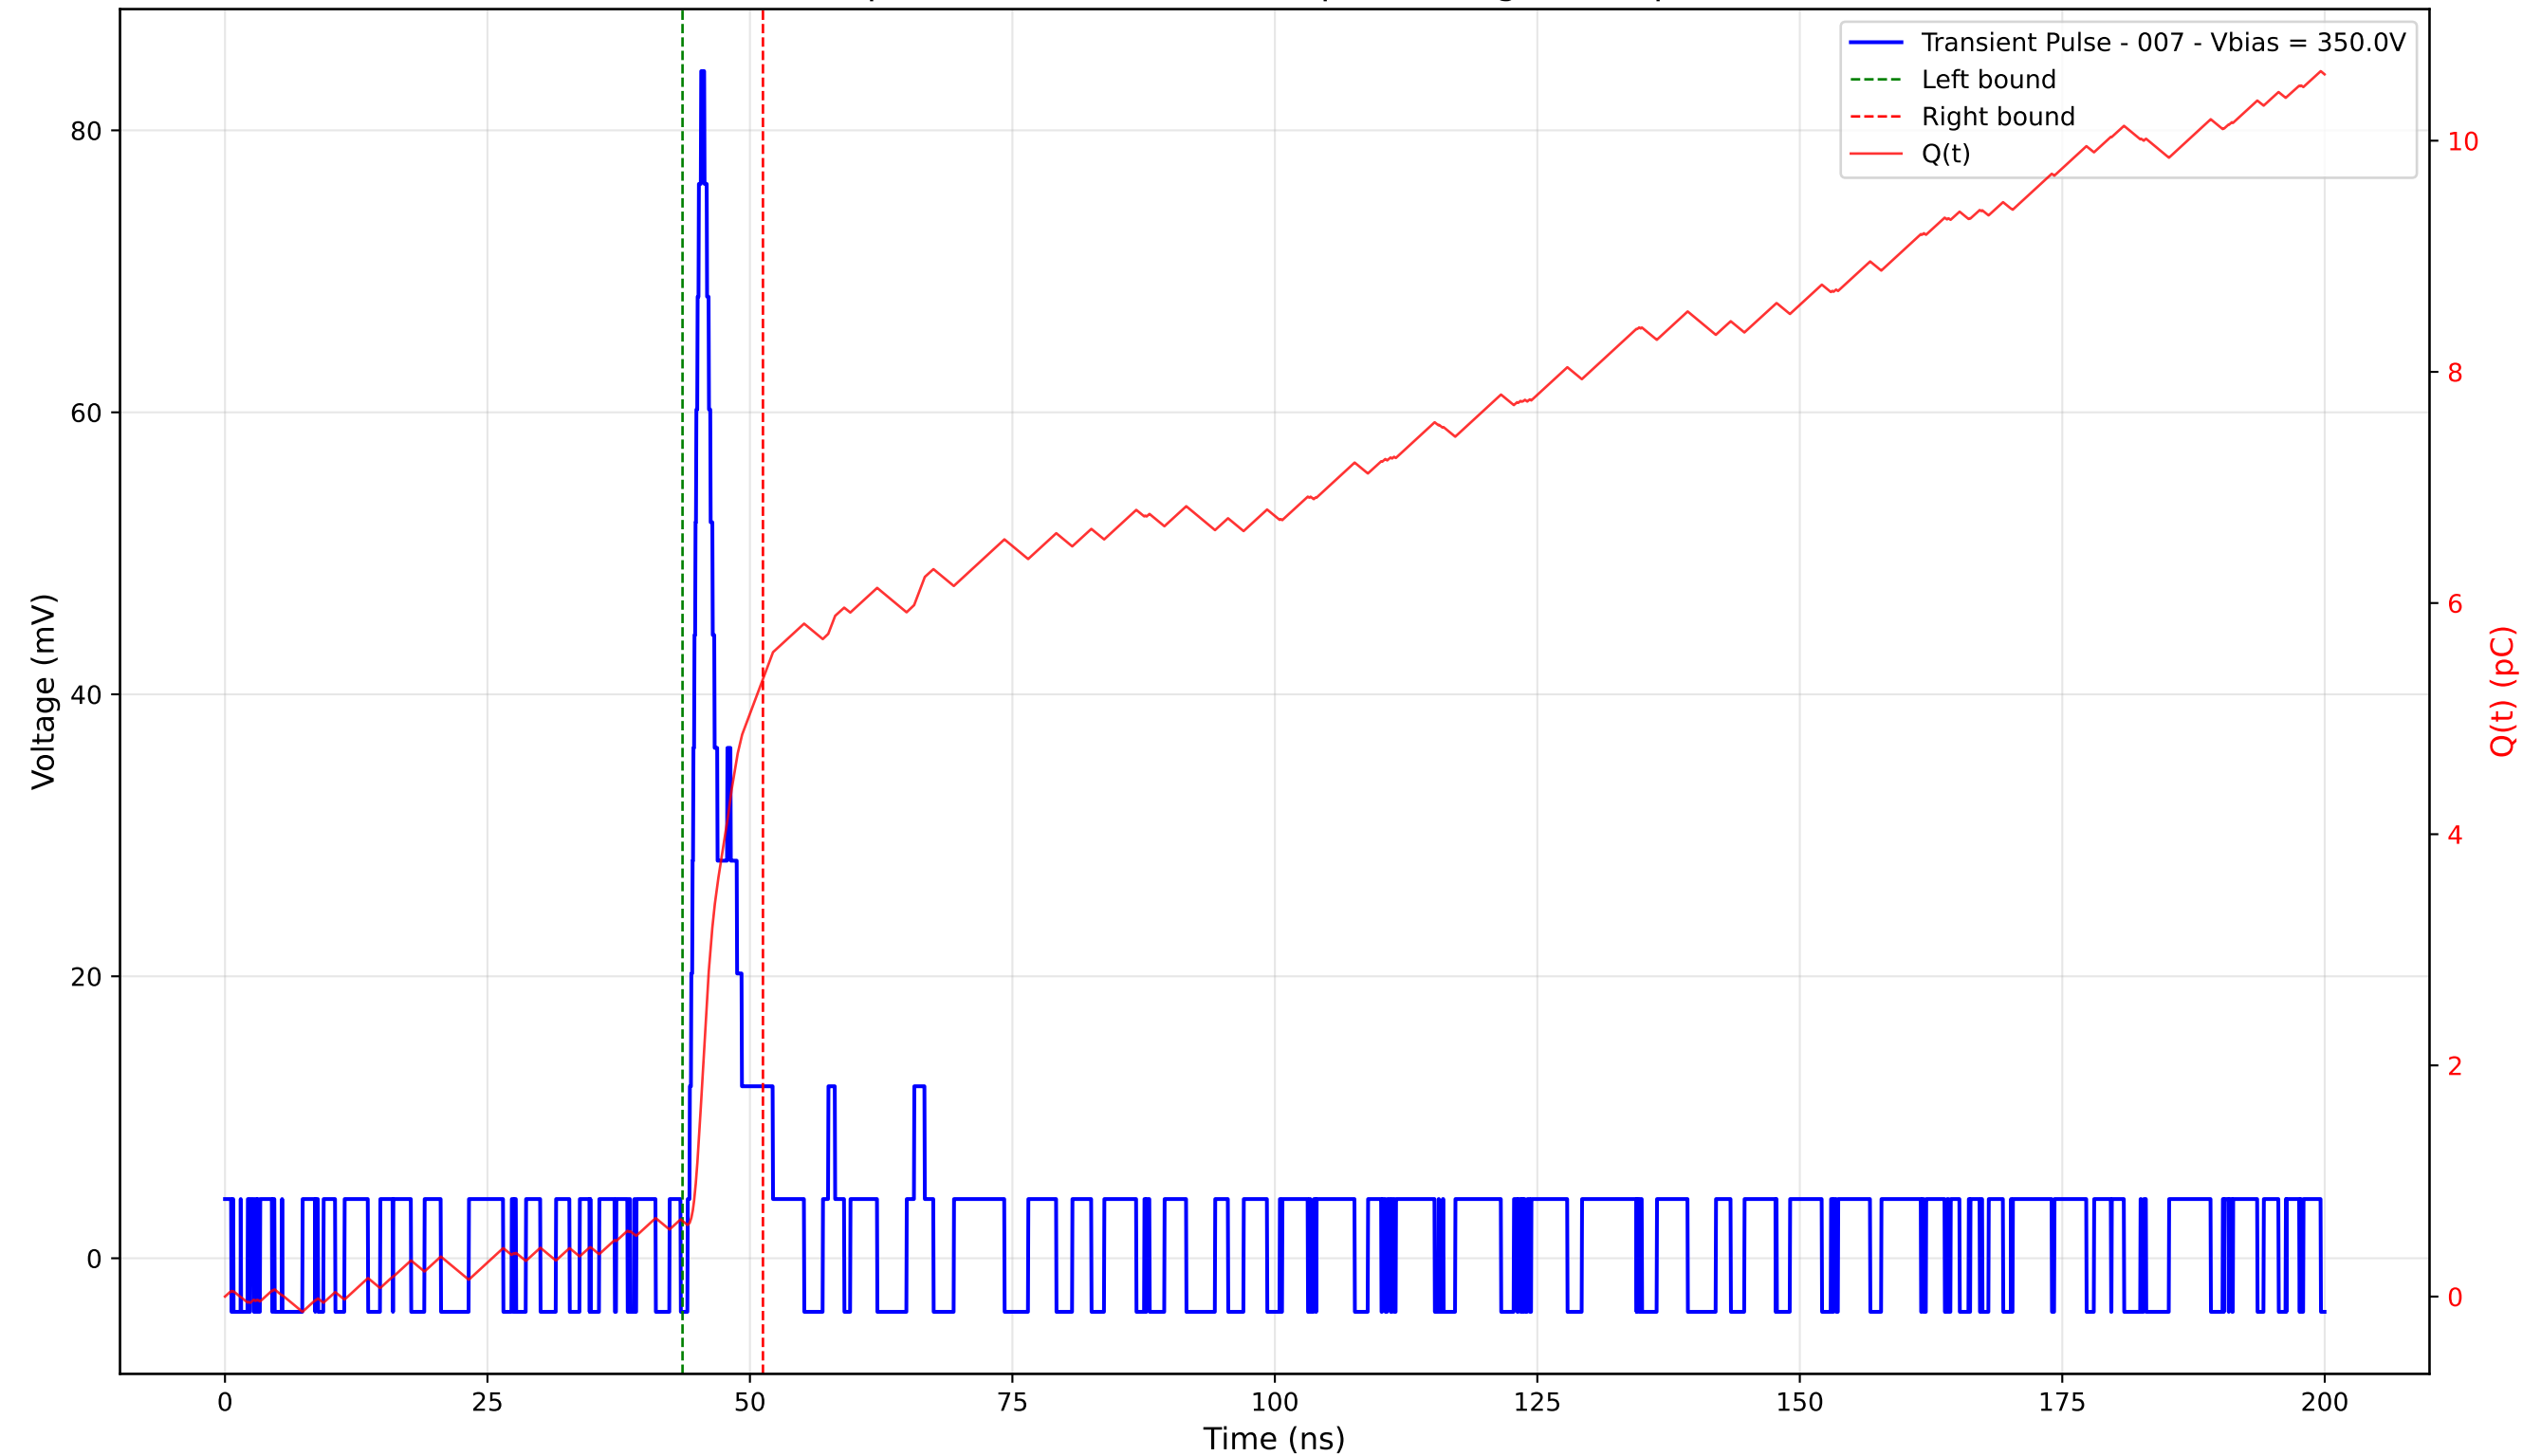


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 9.12 pC - Rise Time: 0.93 ns

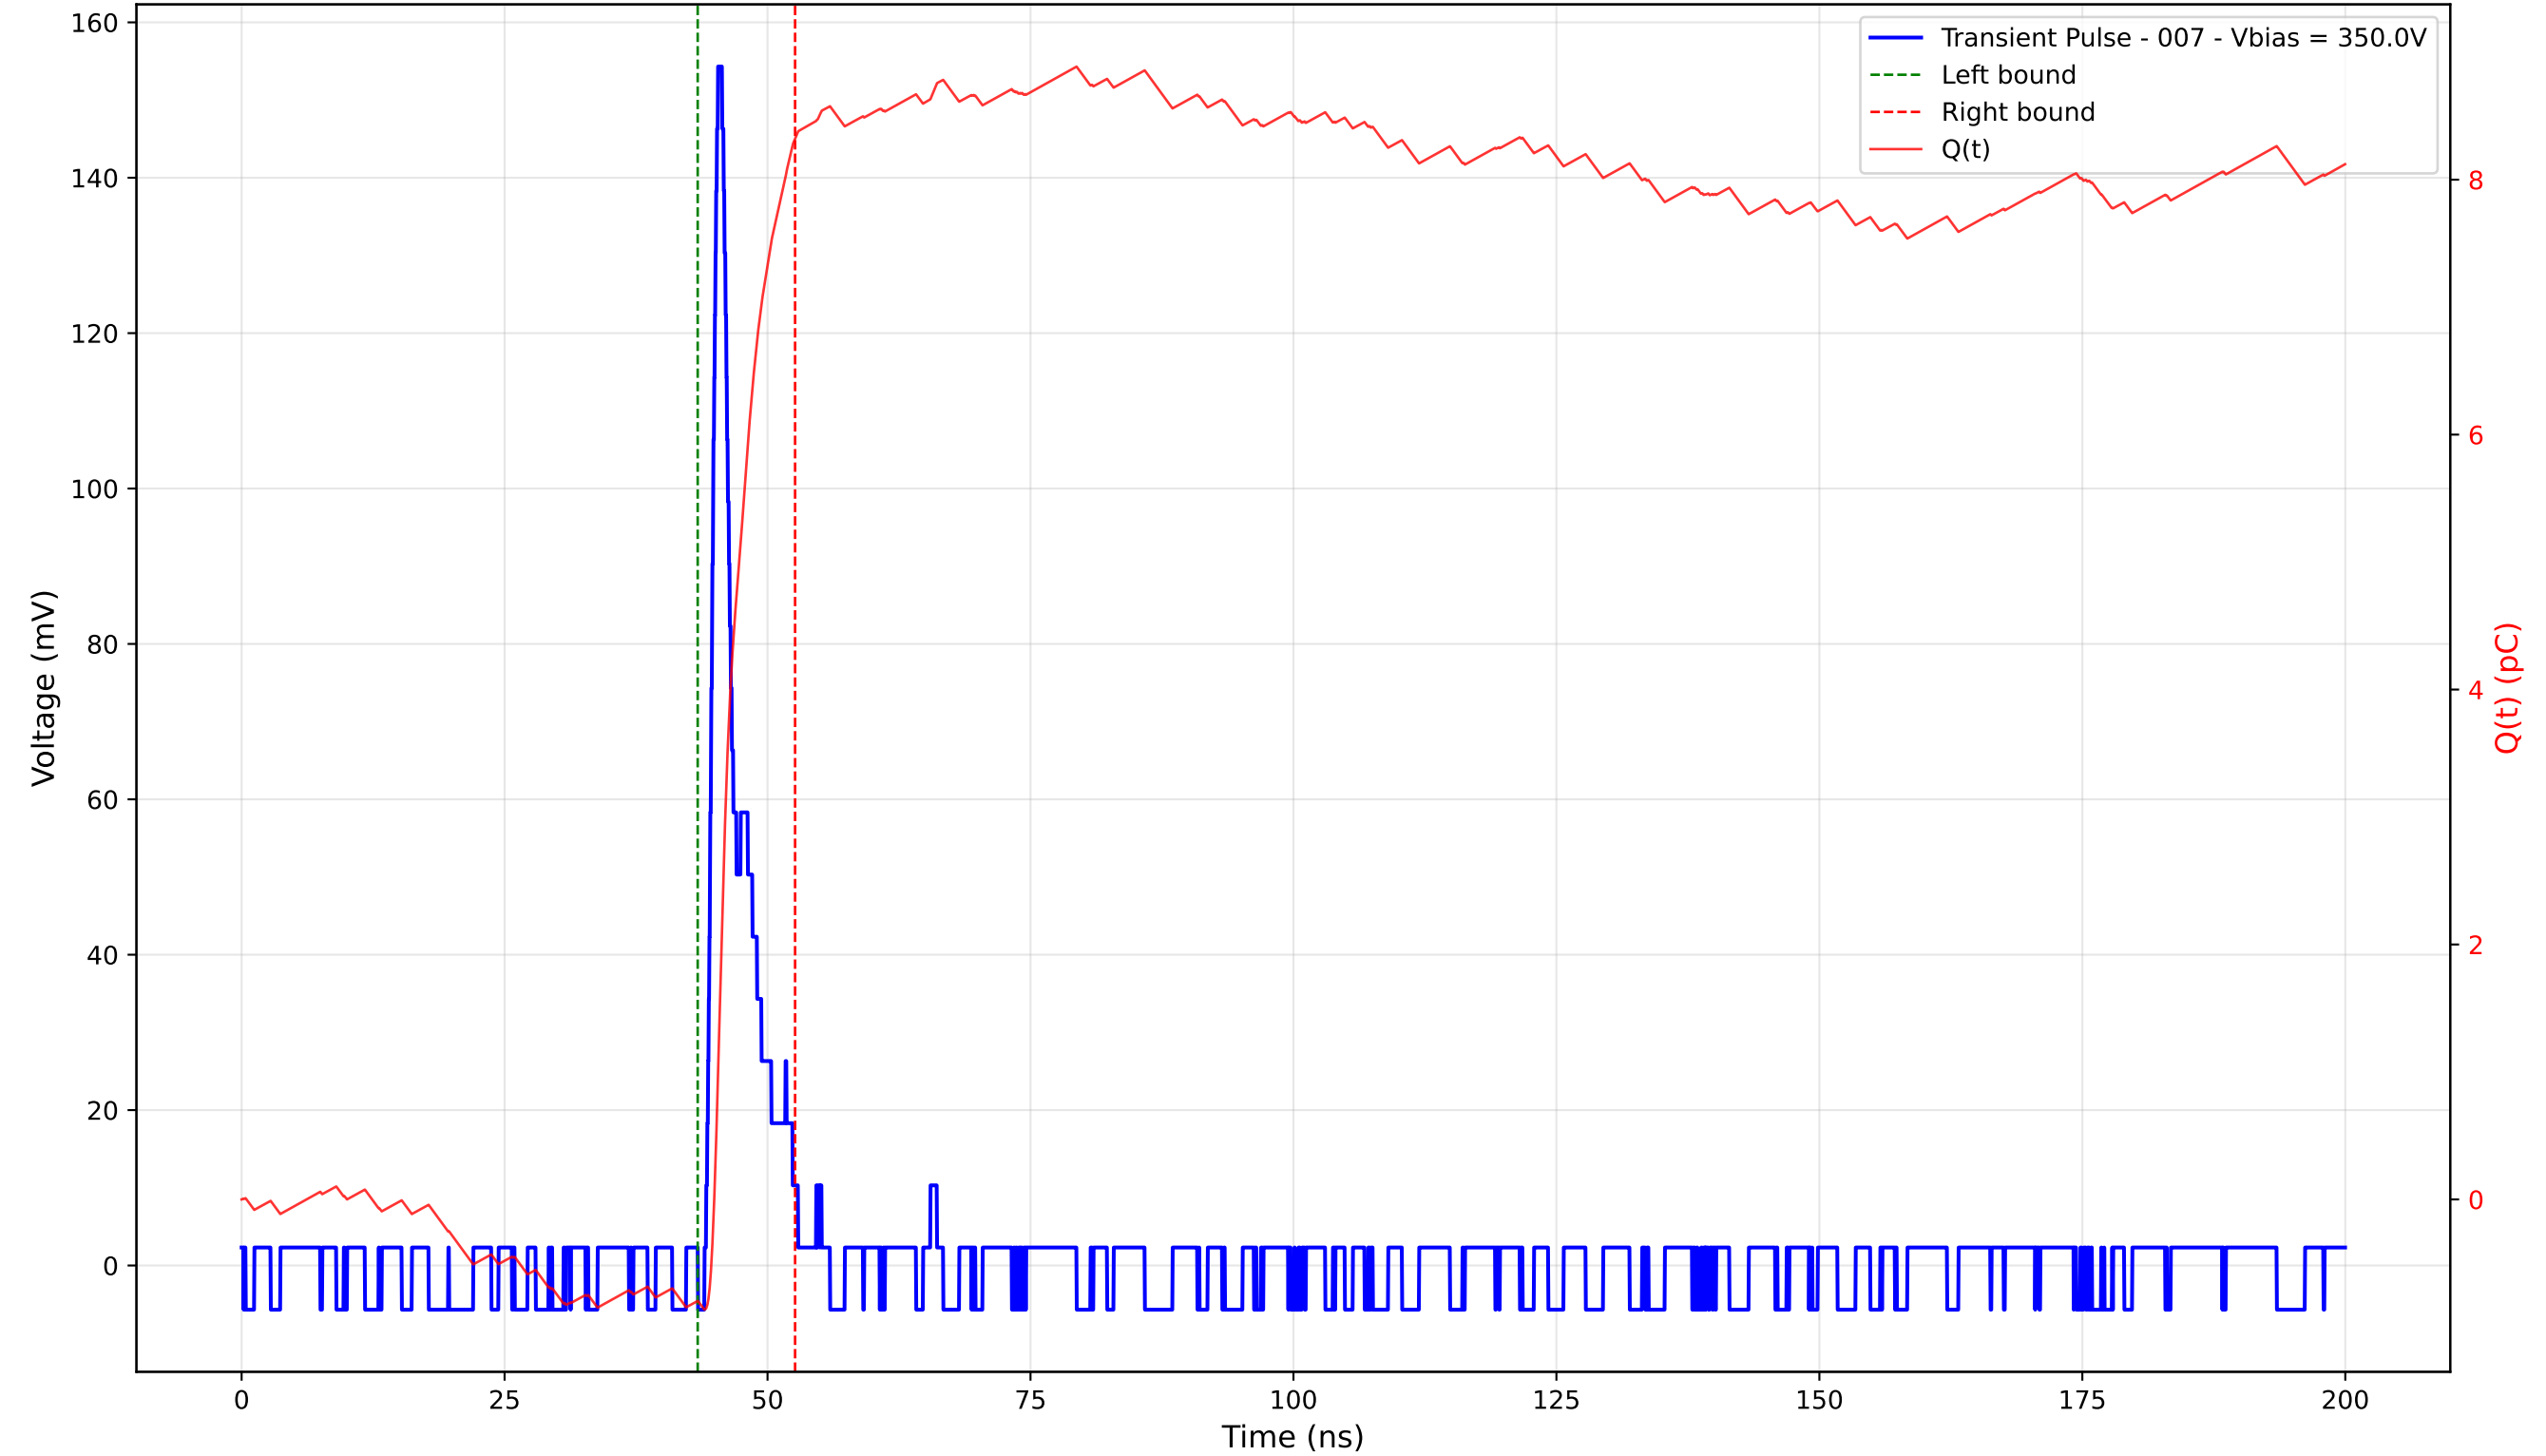


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 14.09 pC - Rise Time: 0.91 ns

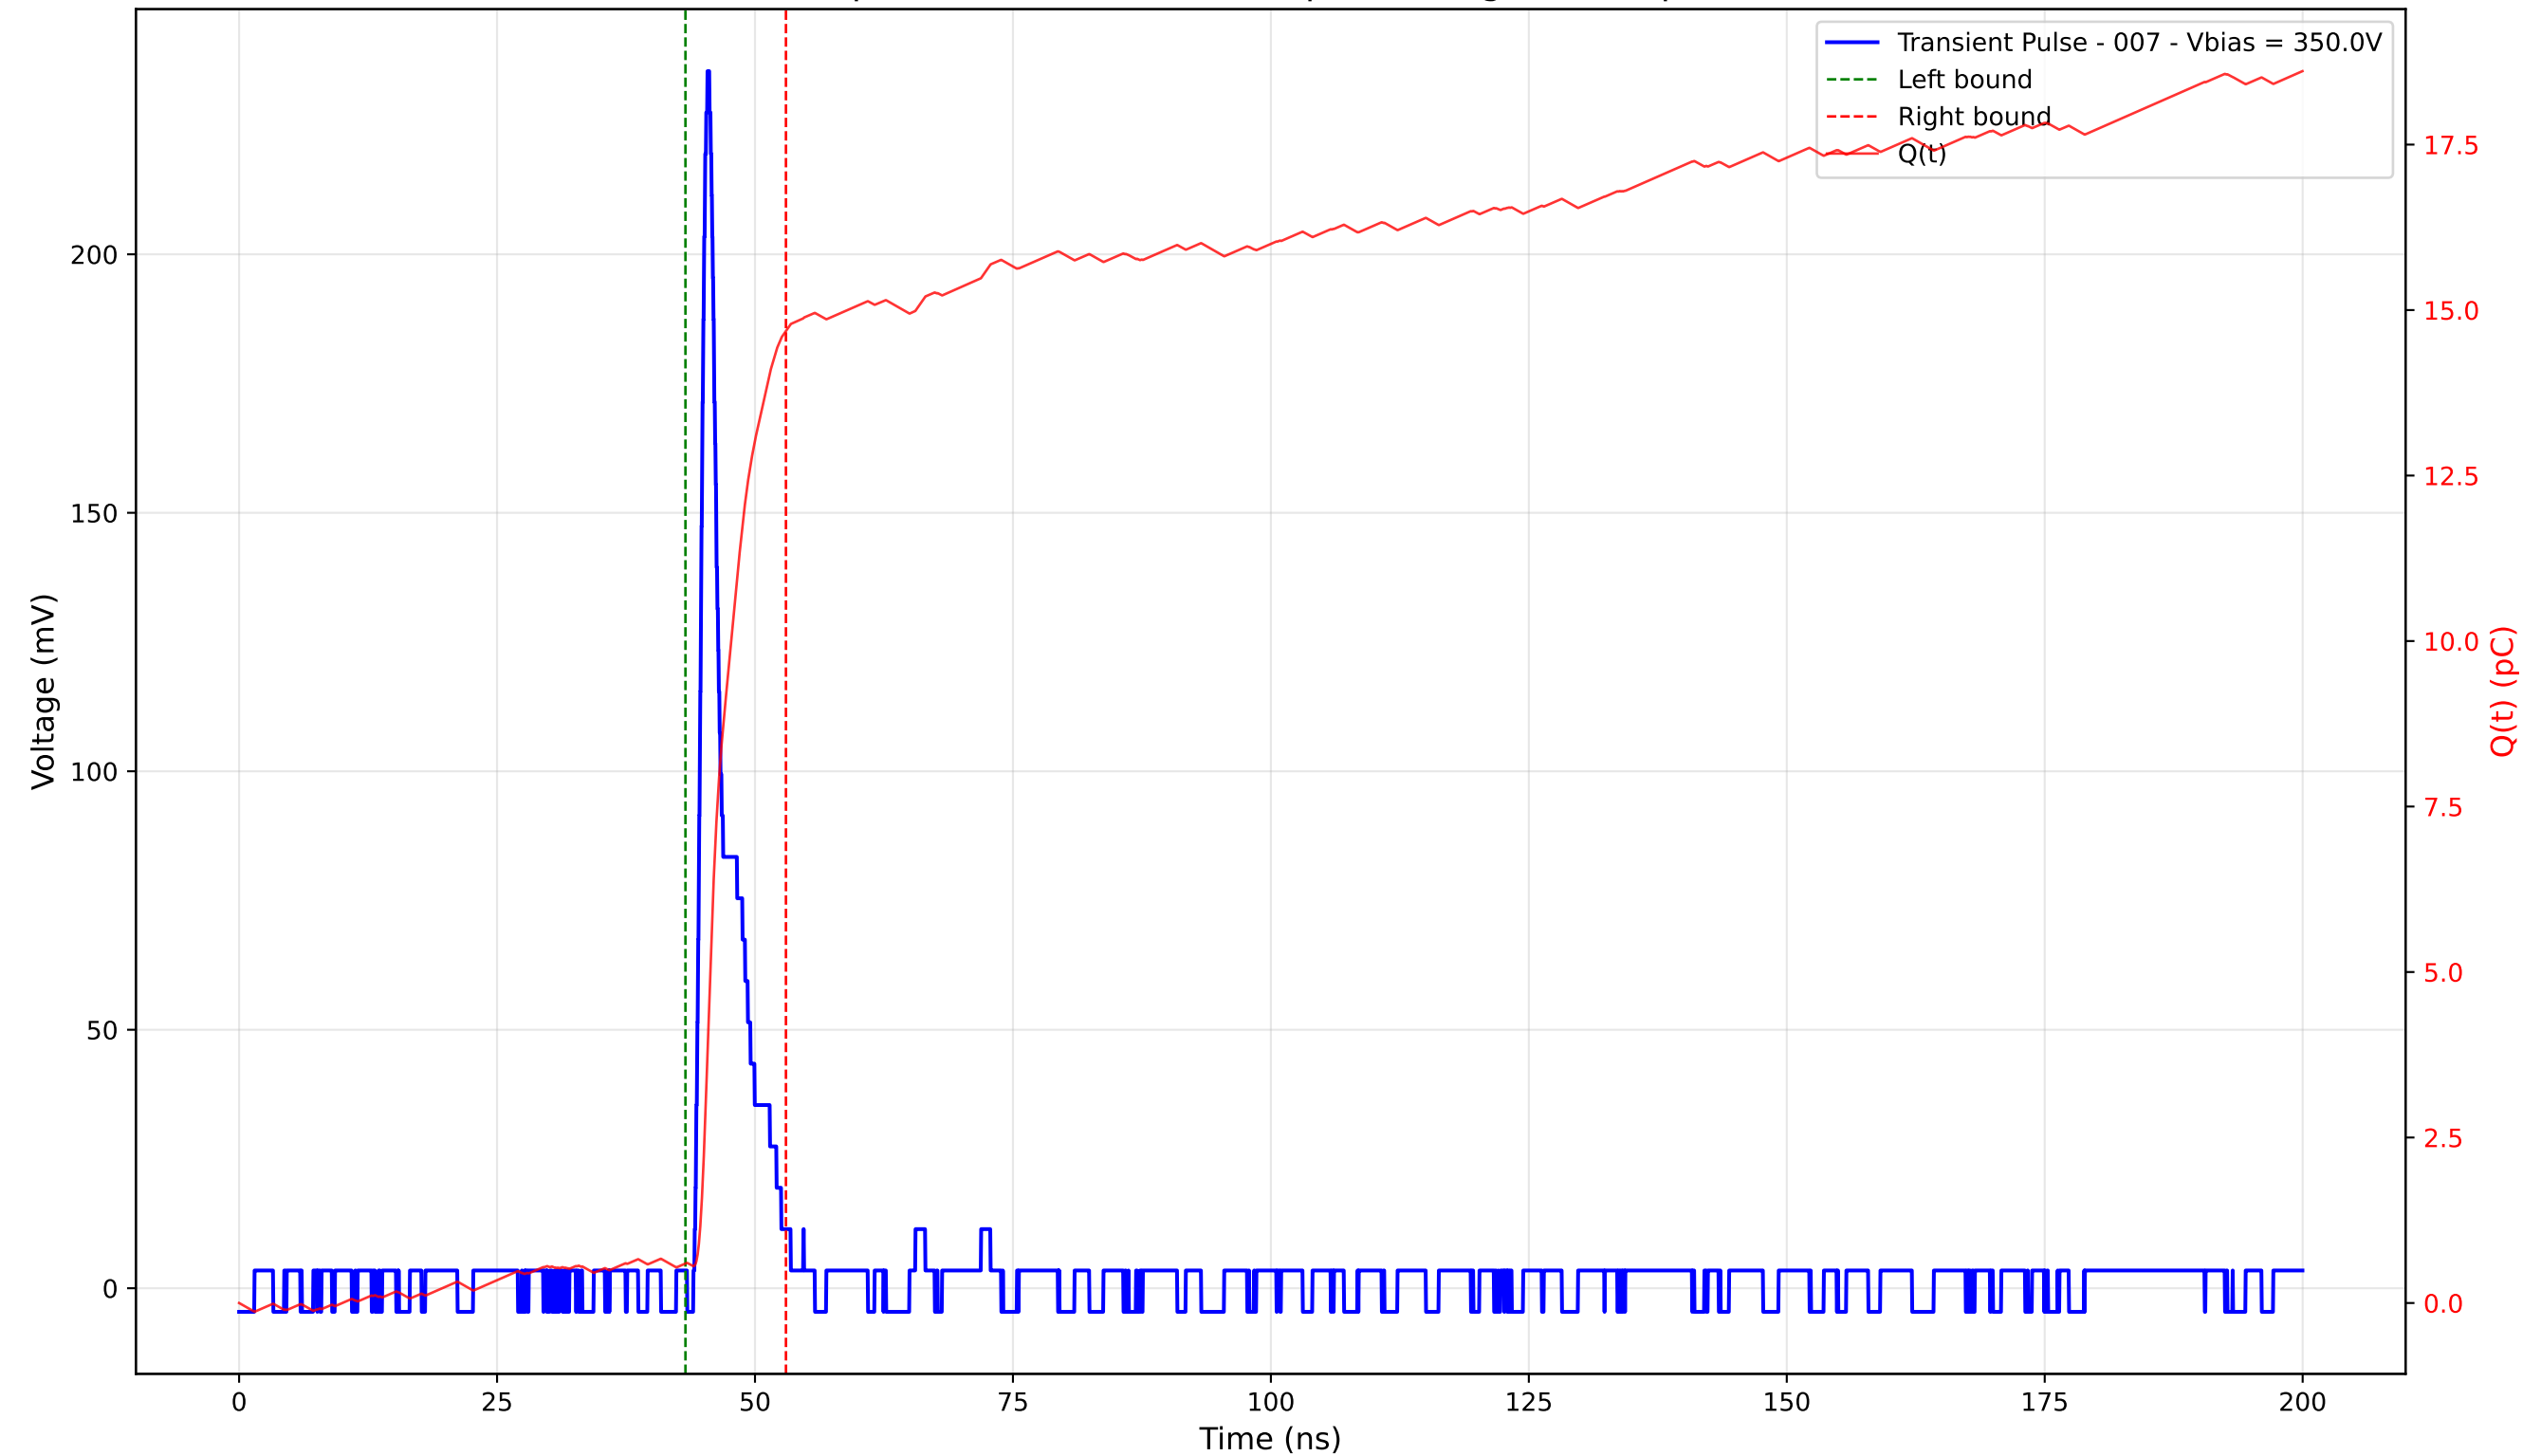


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 18.79 pC - Rise Time: 0.91 ns

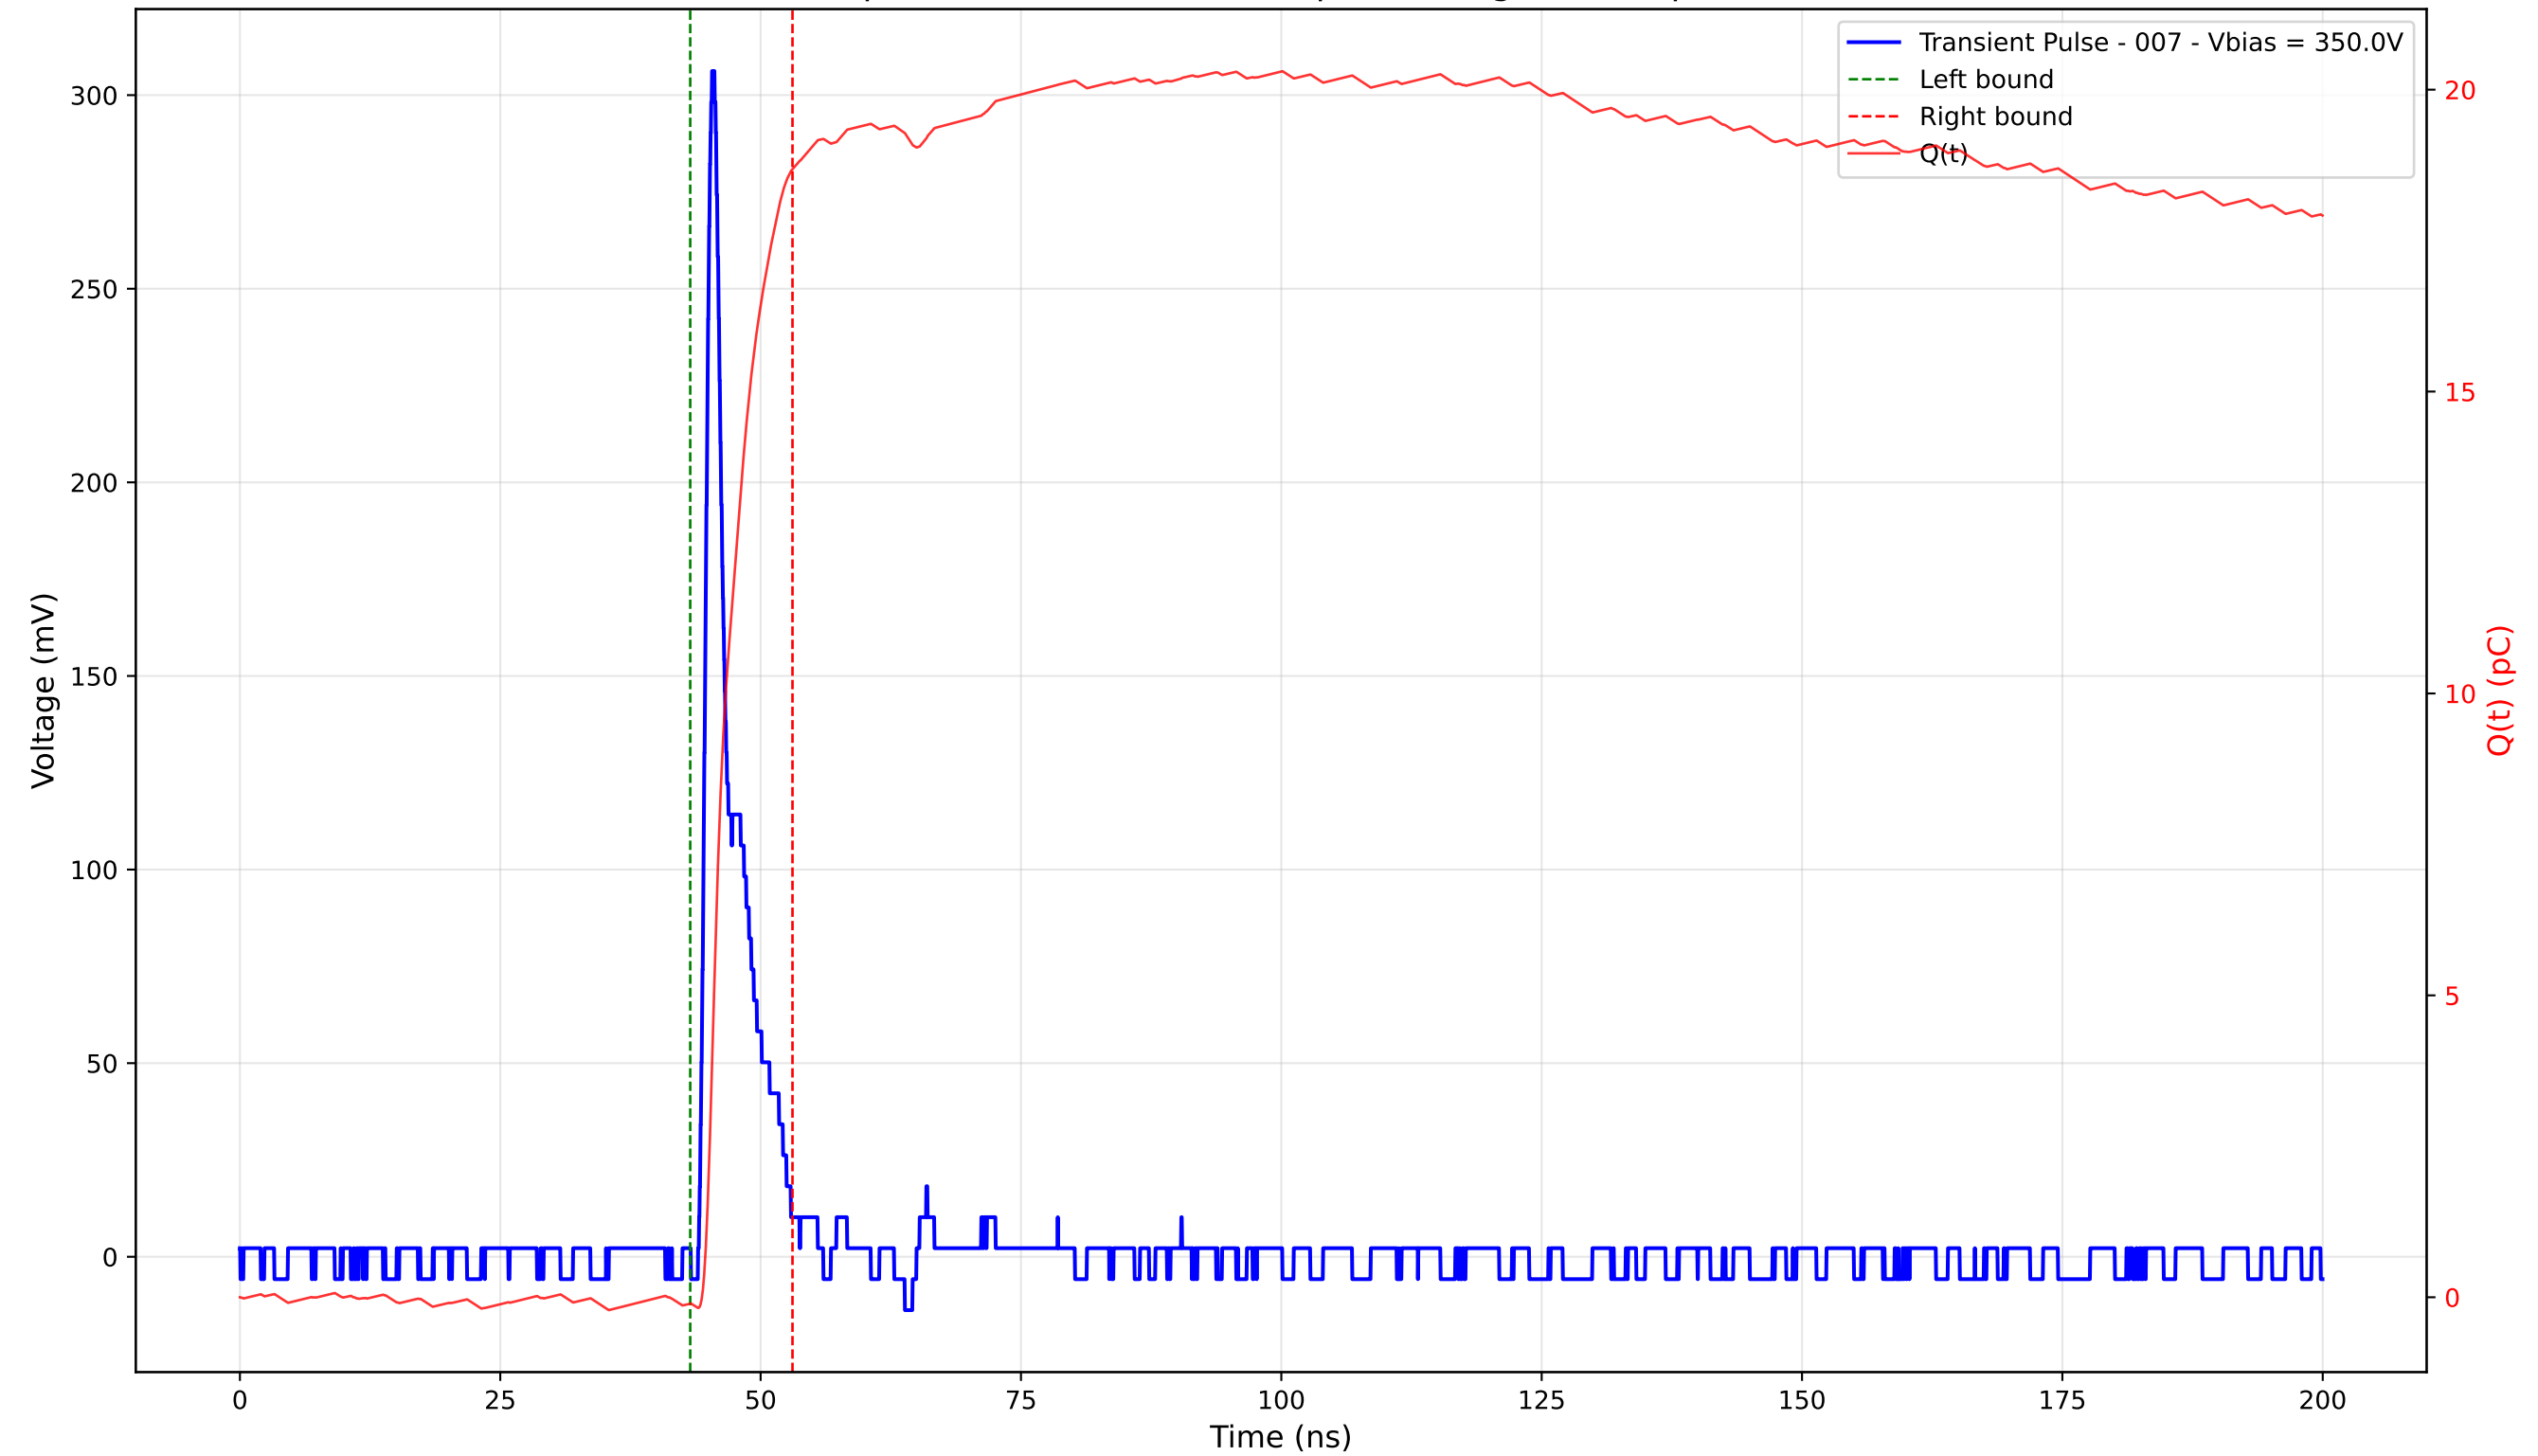


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 23.50 pC - Rise Time: 0.89 ns

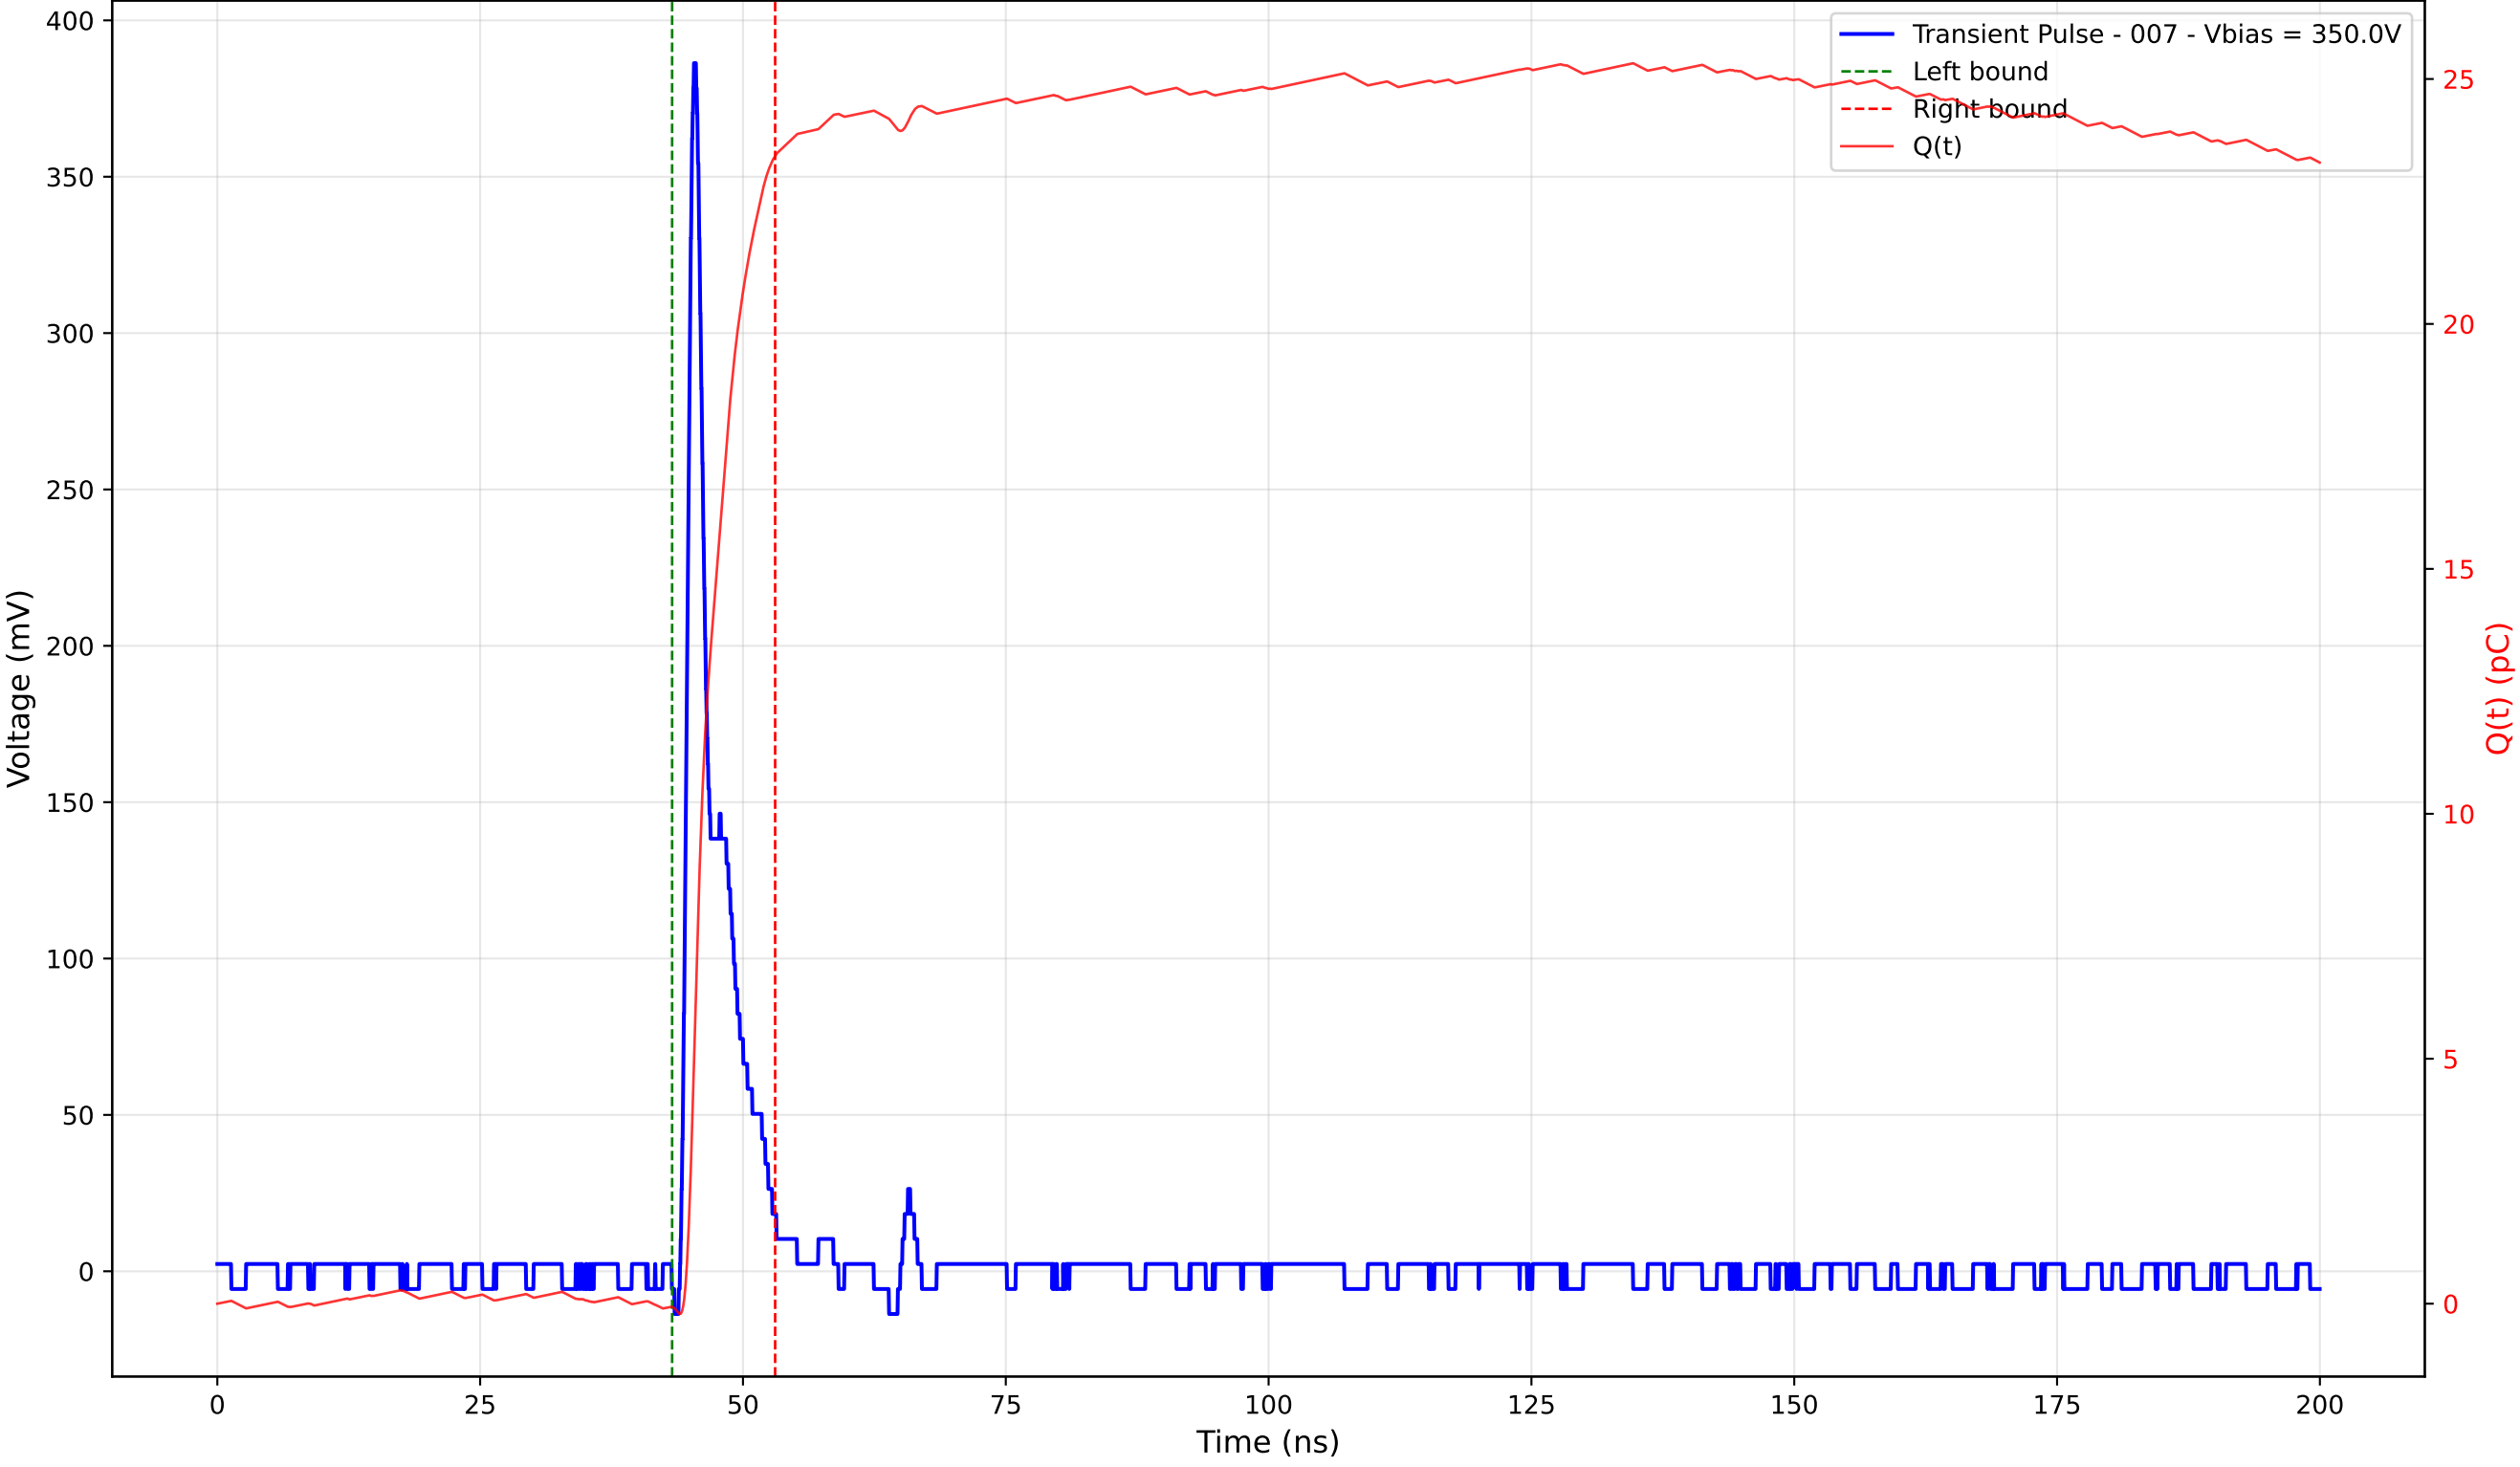


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 28.39 pC - Rise Time: 0.93 ns

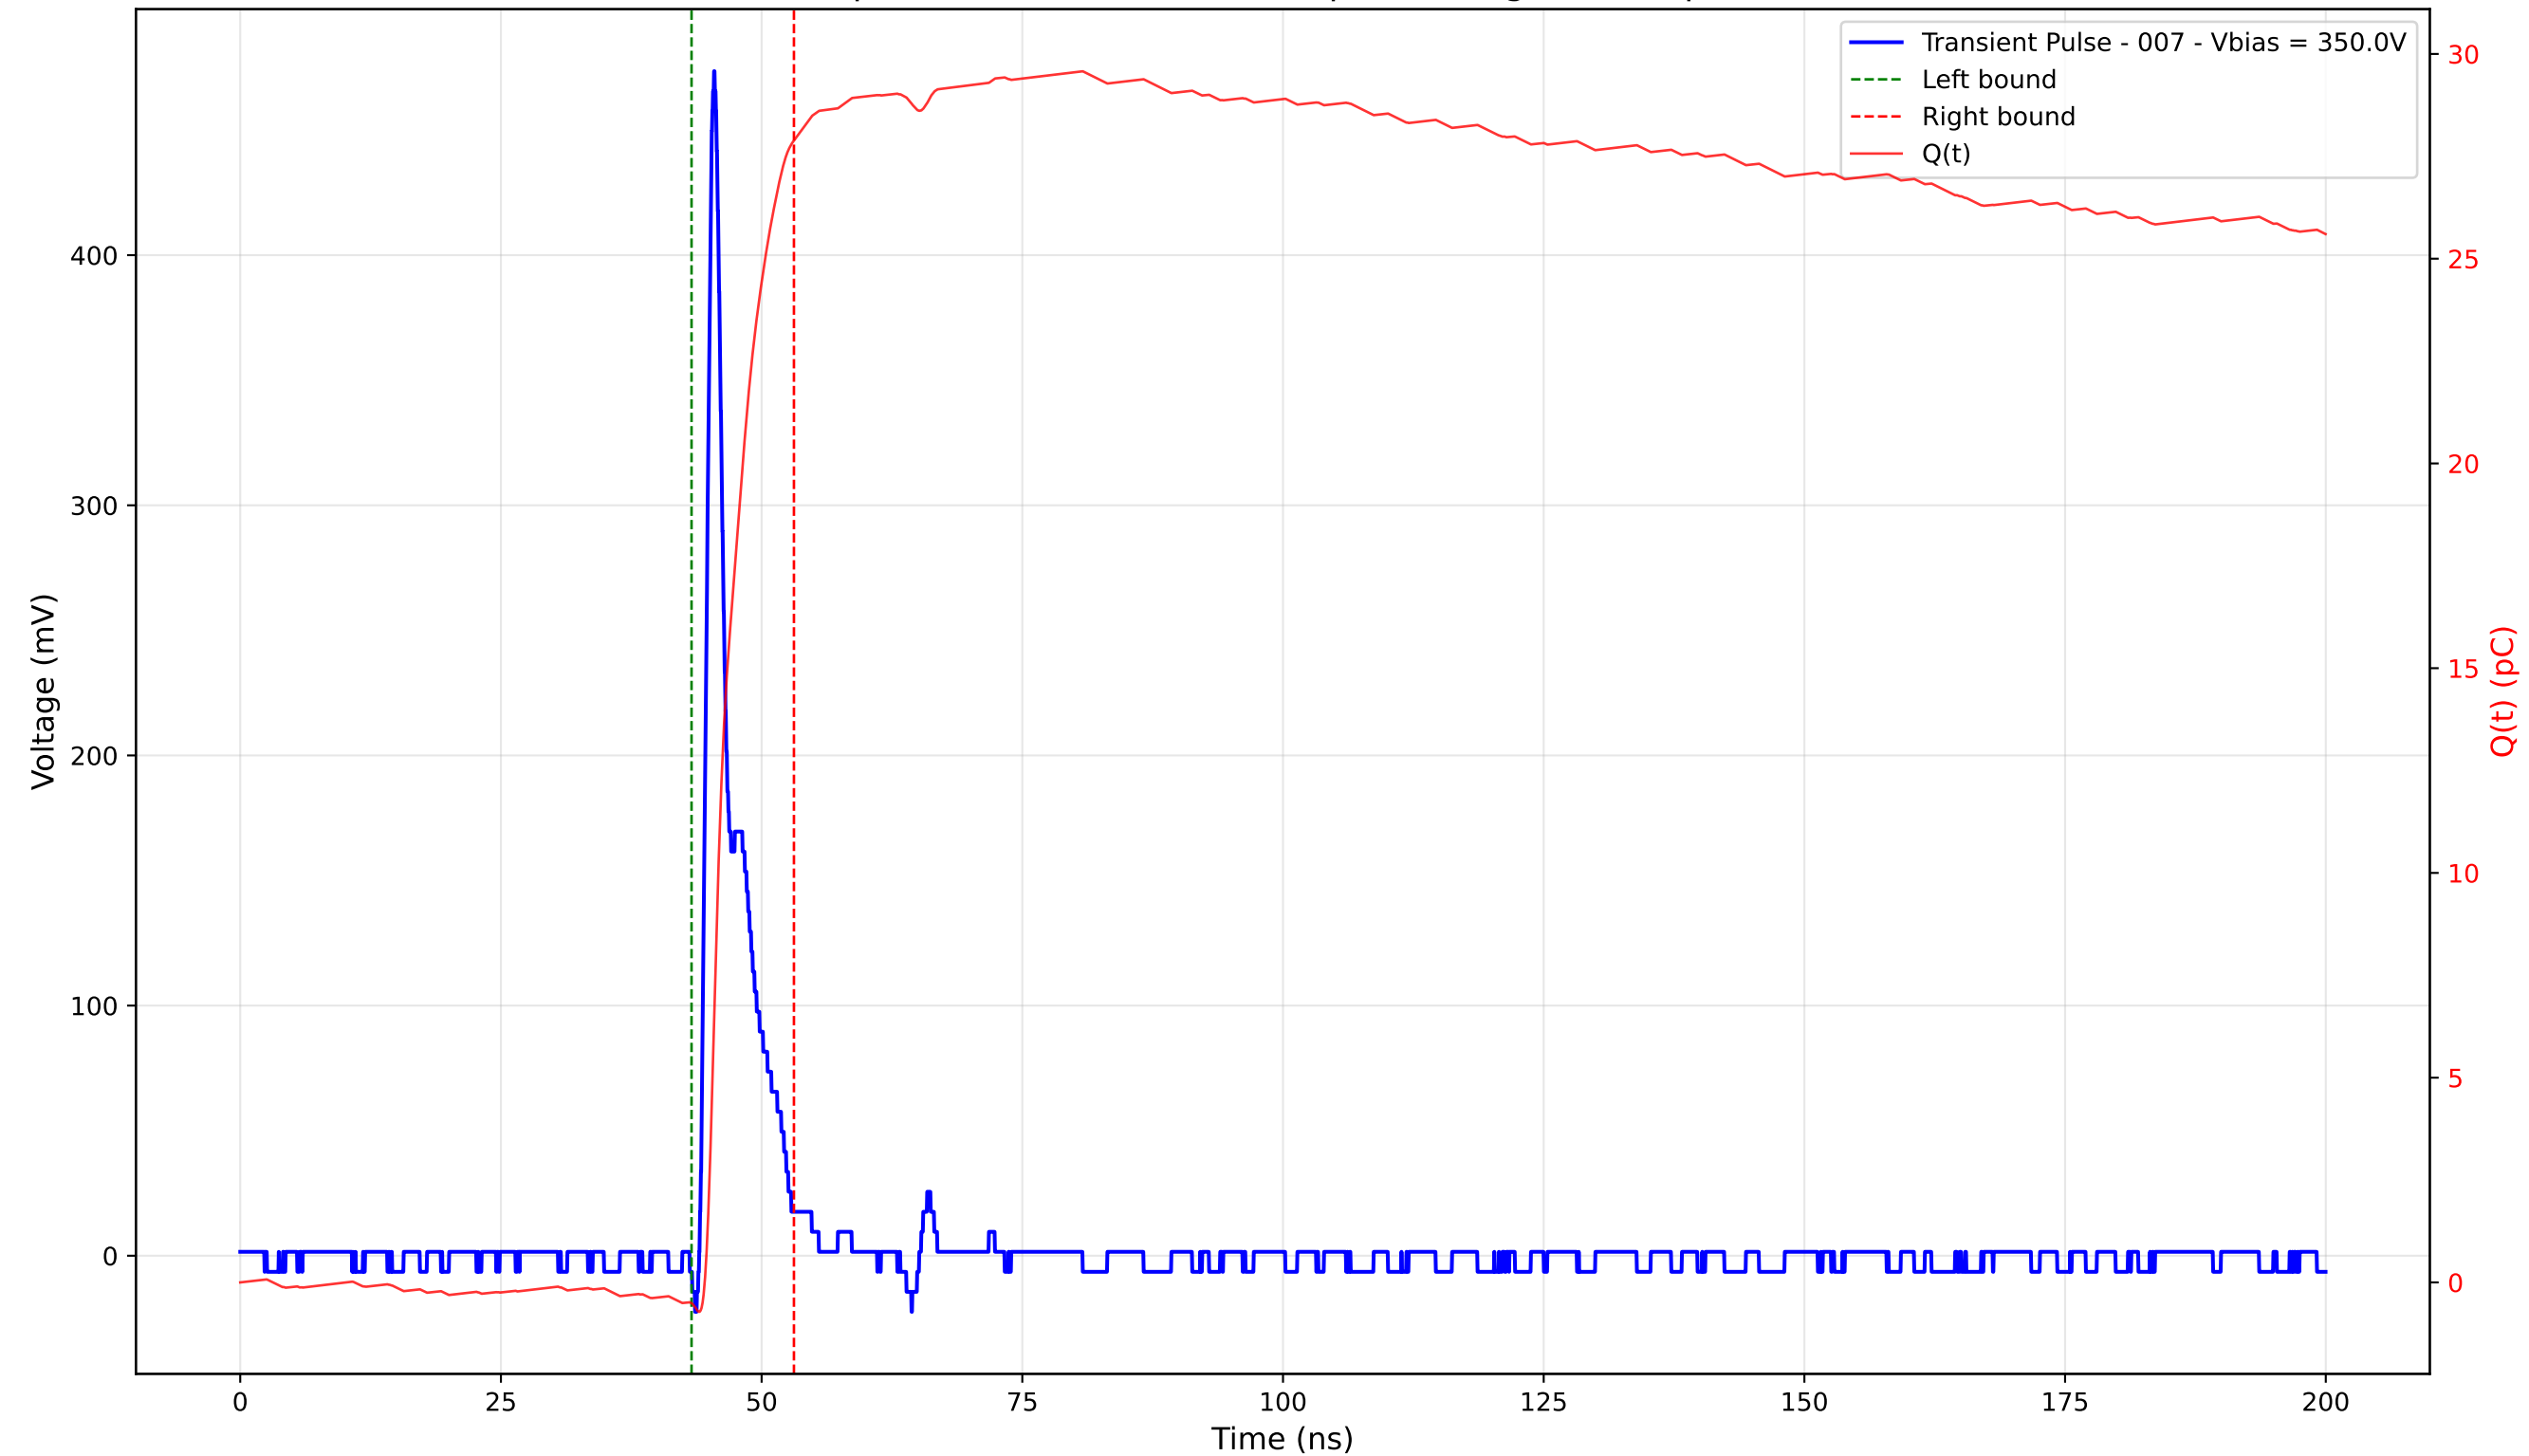


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 32.56 pC - Rise Time: 0.90 ns

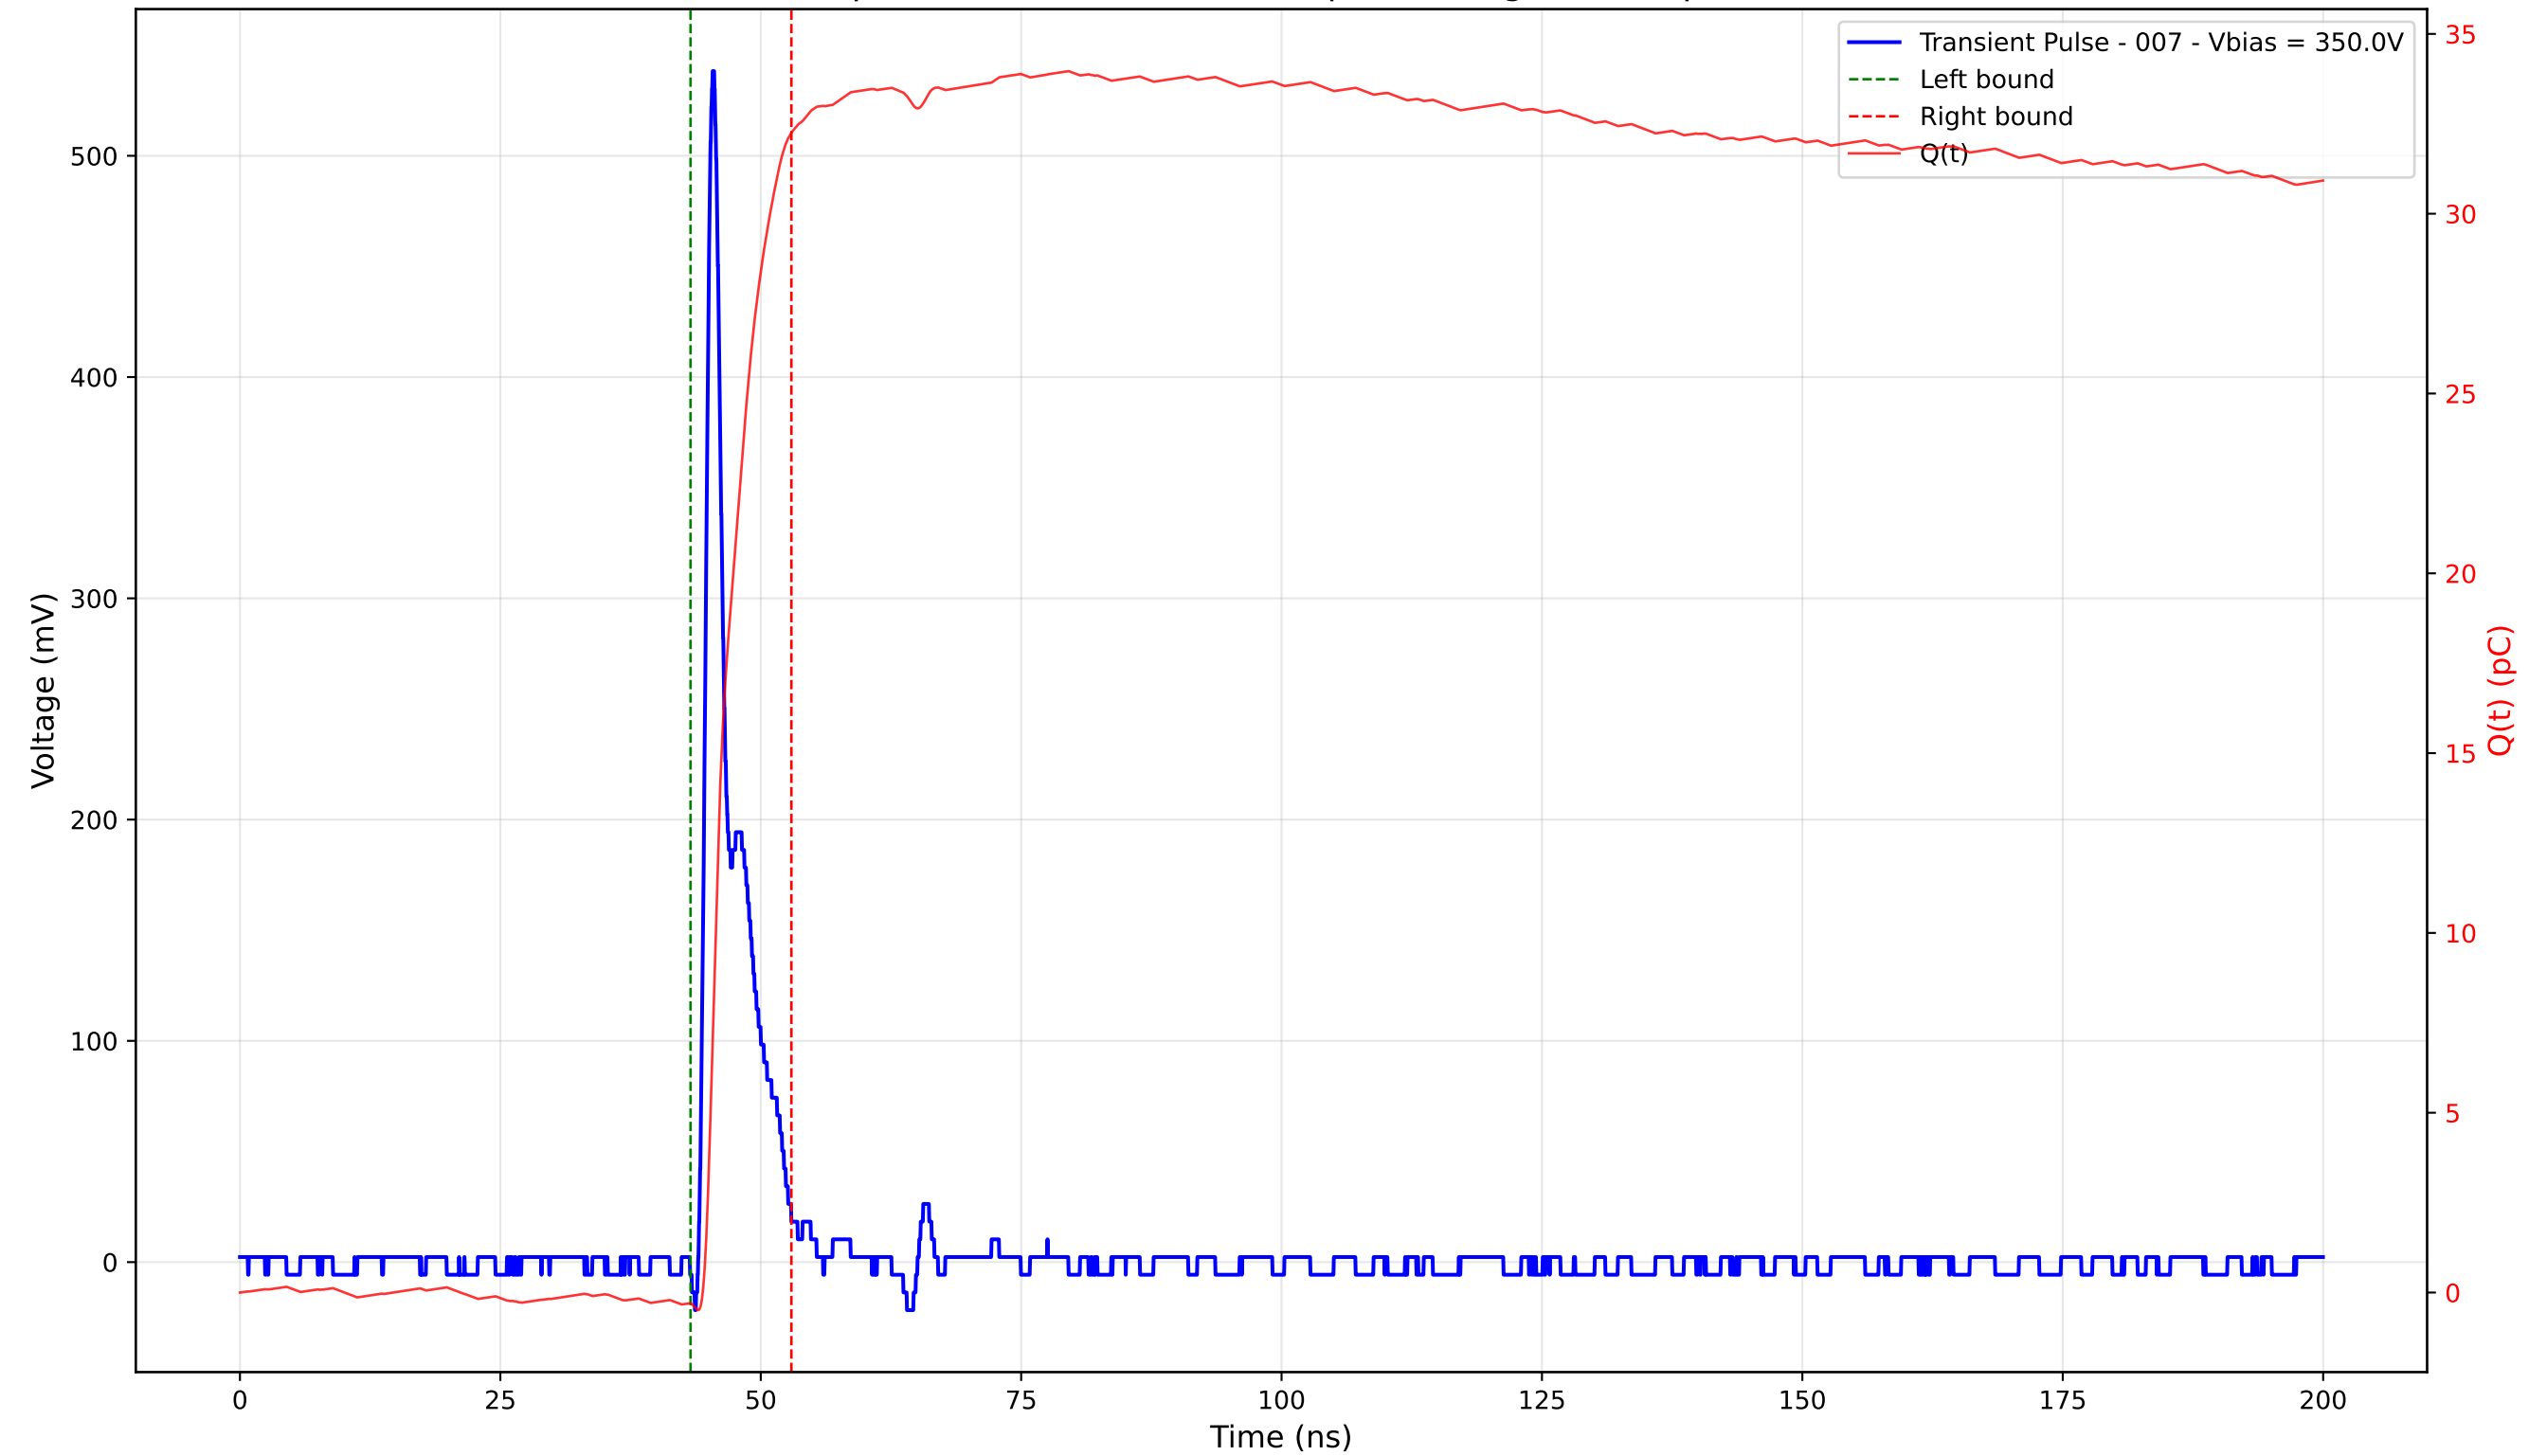


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 34.09 pC - Rise Time: 0.88 ns

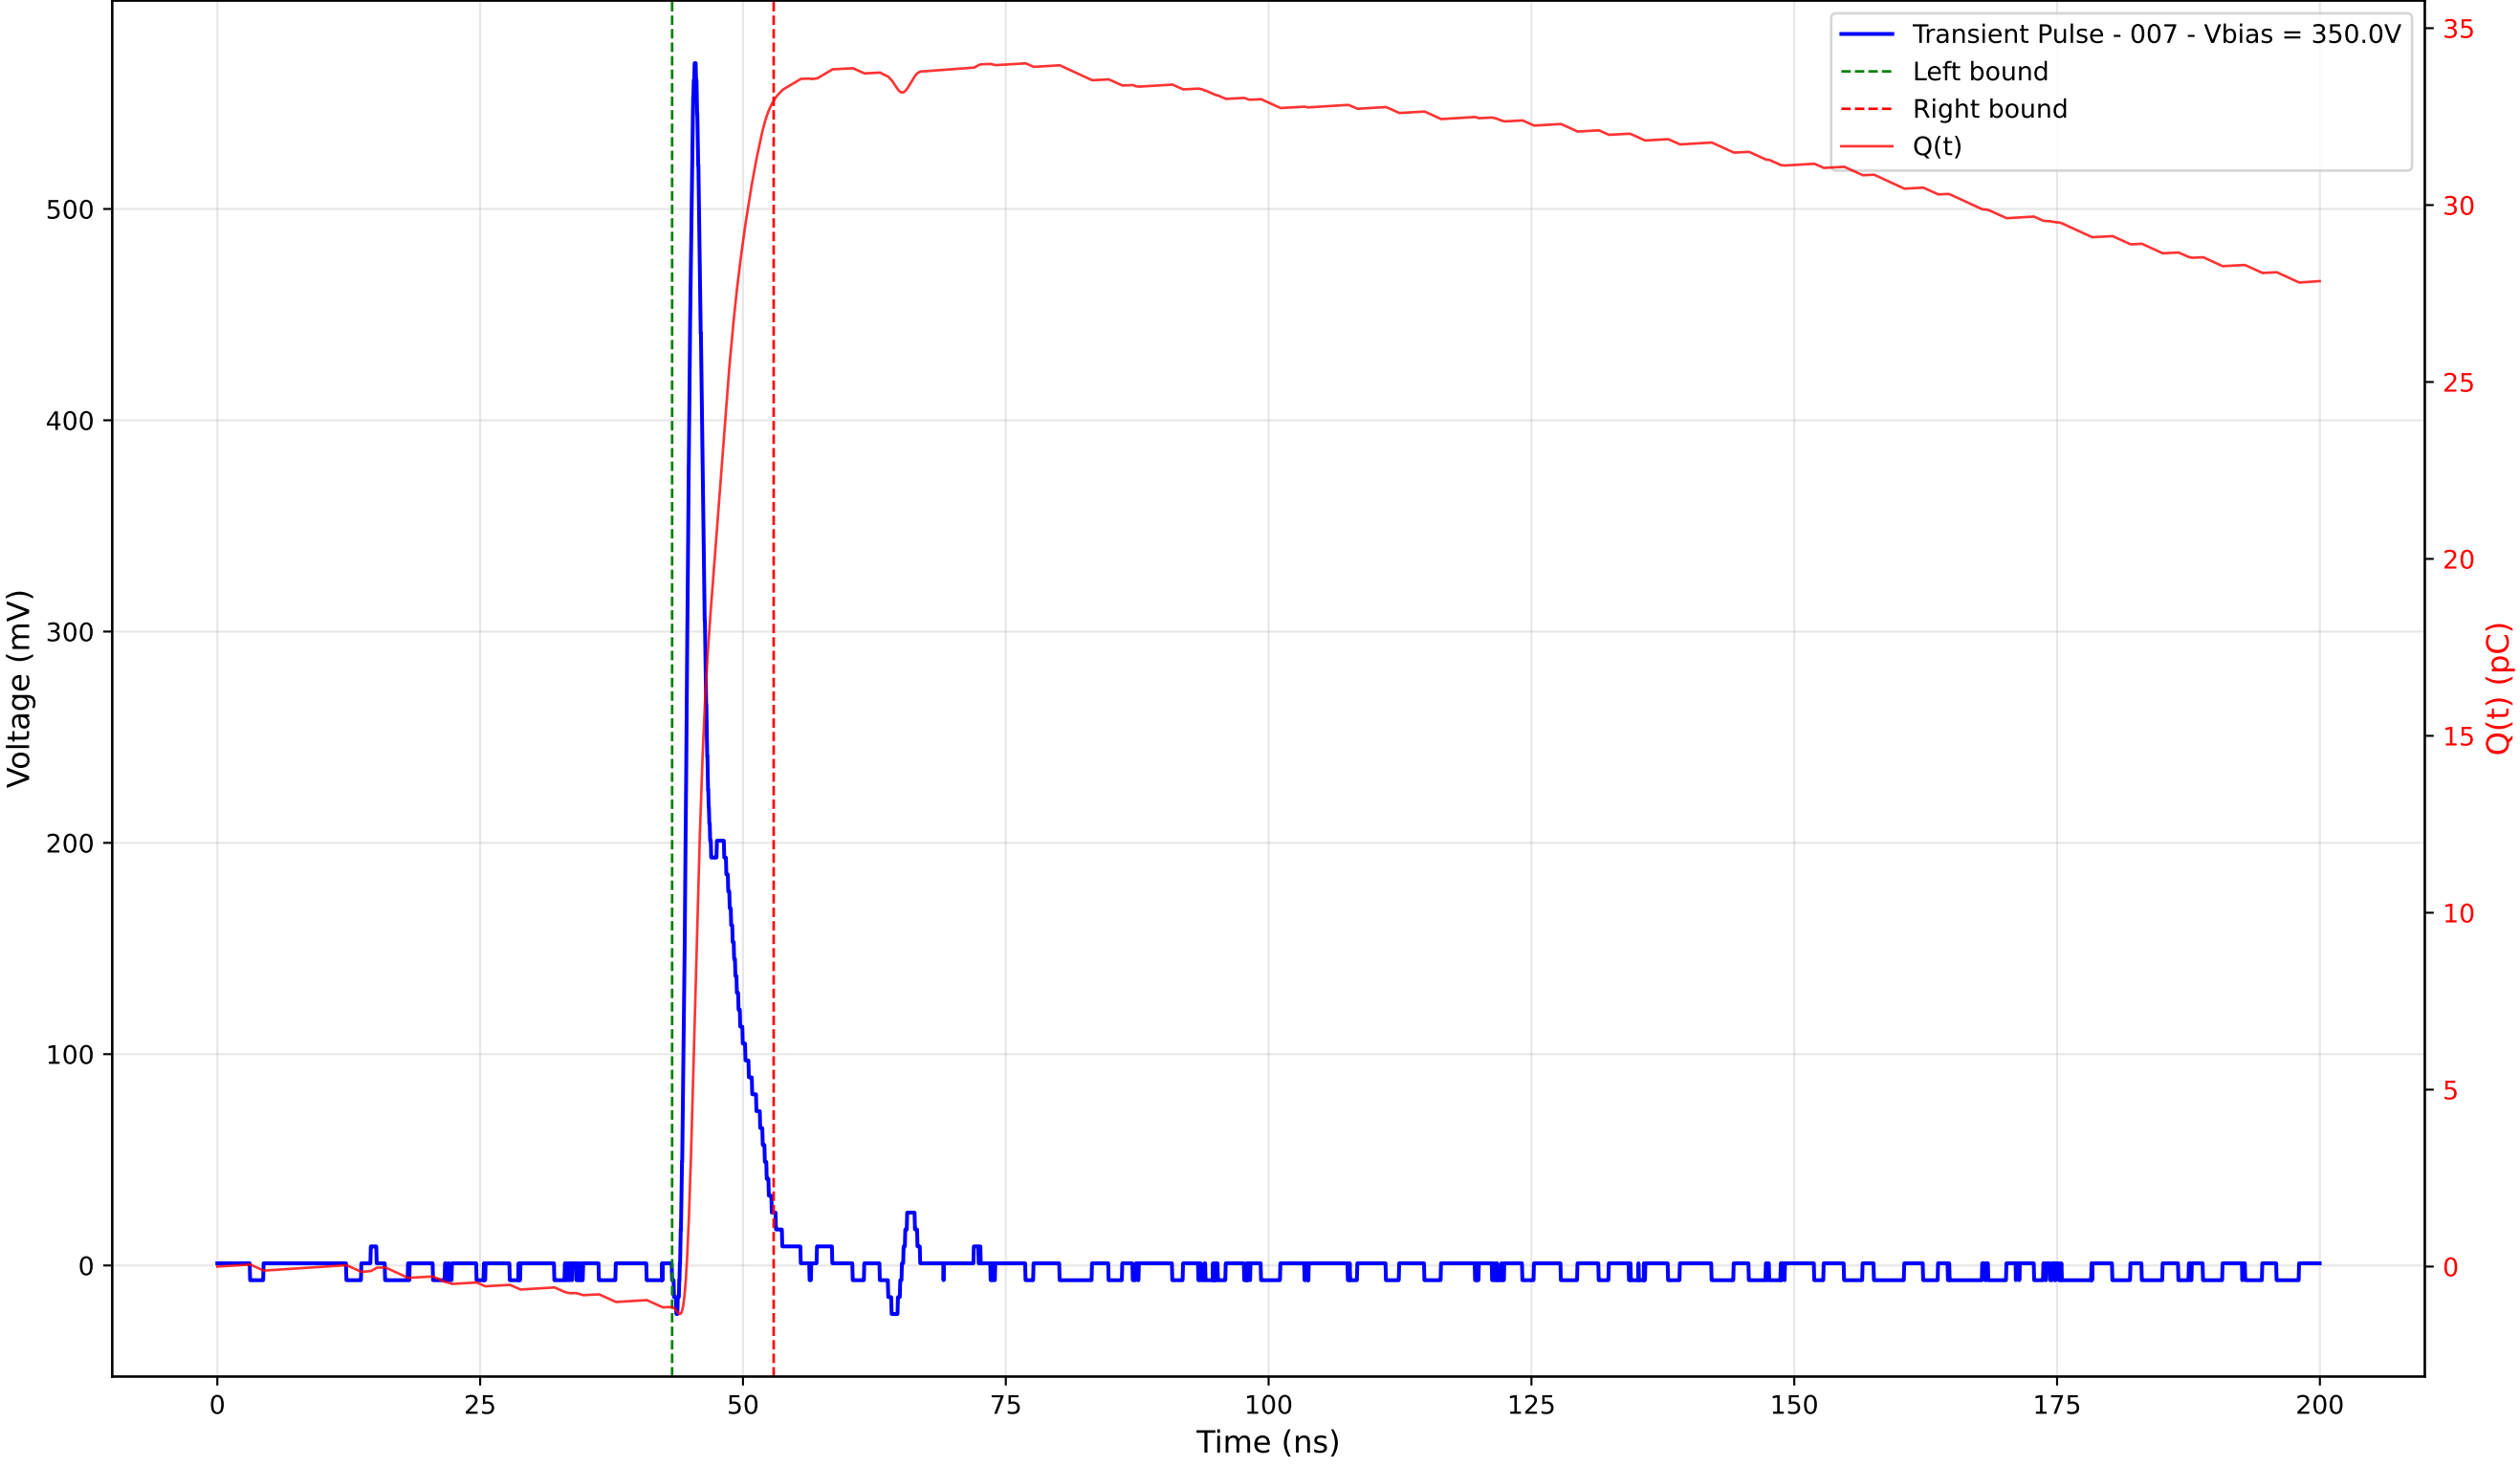


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 35.67 pC - Rise Time: 0.90 ns

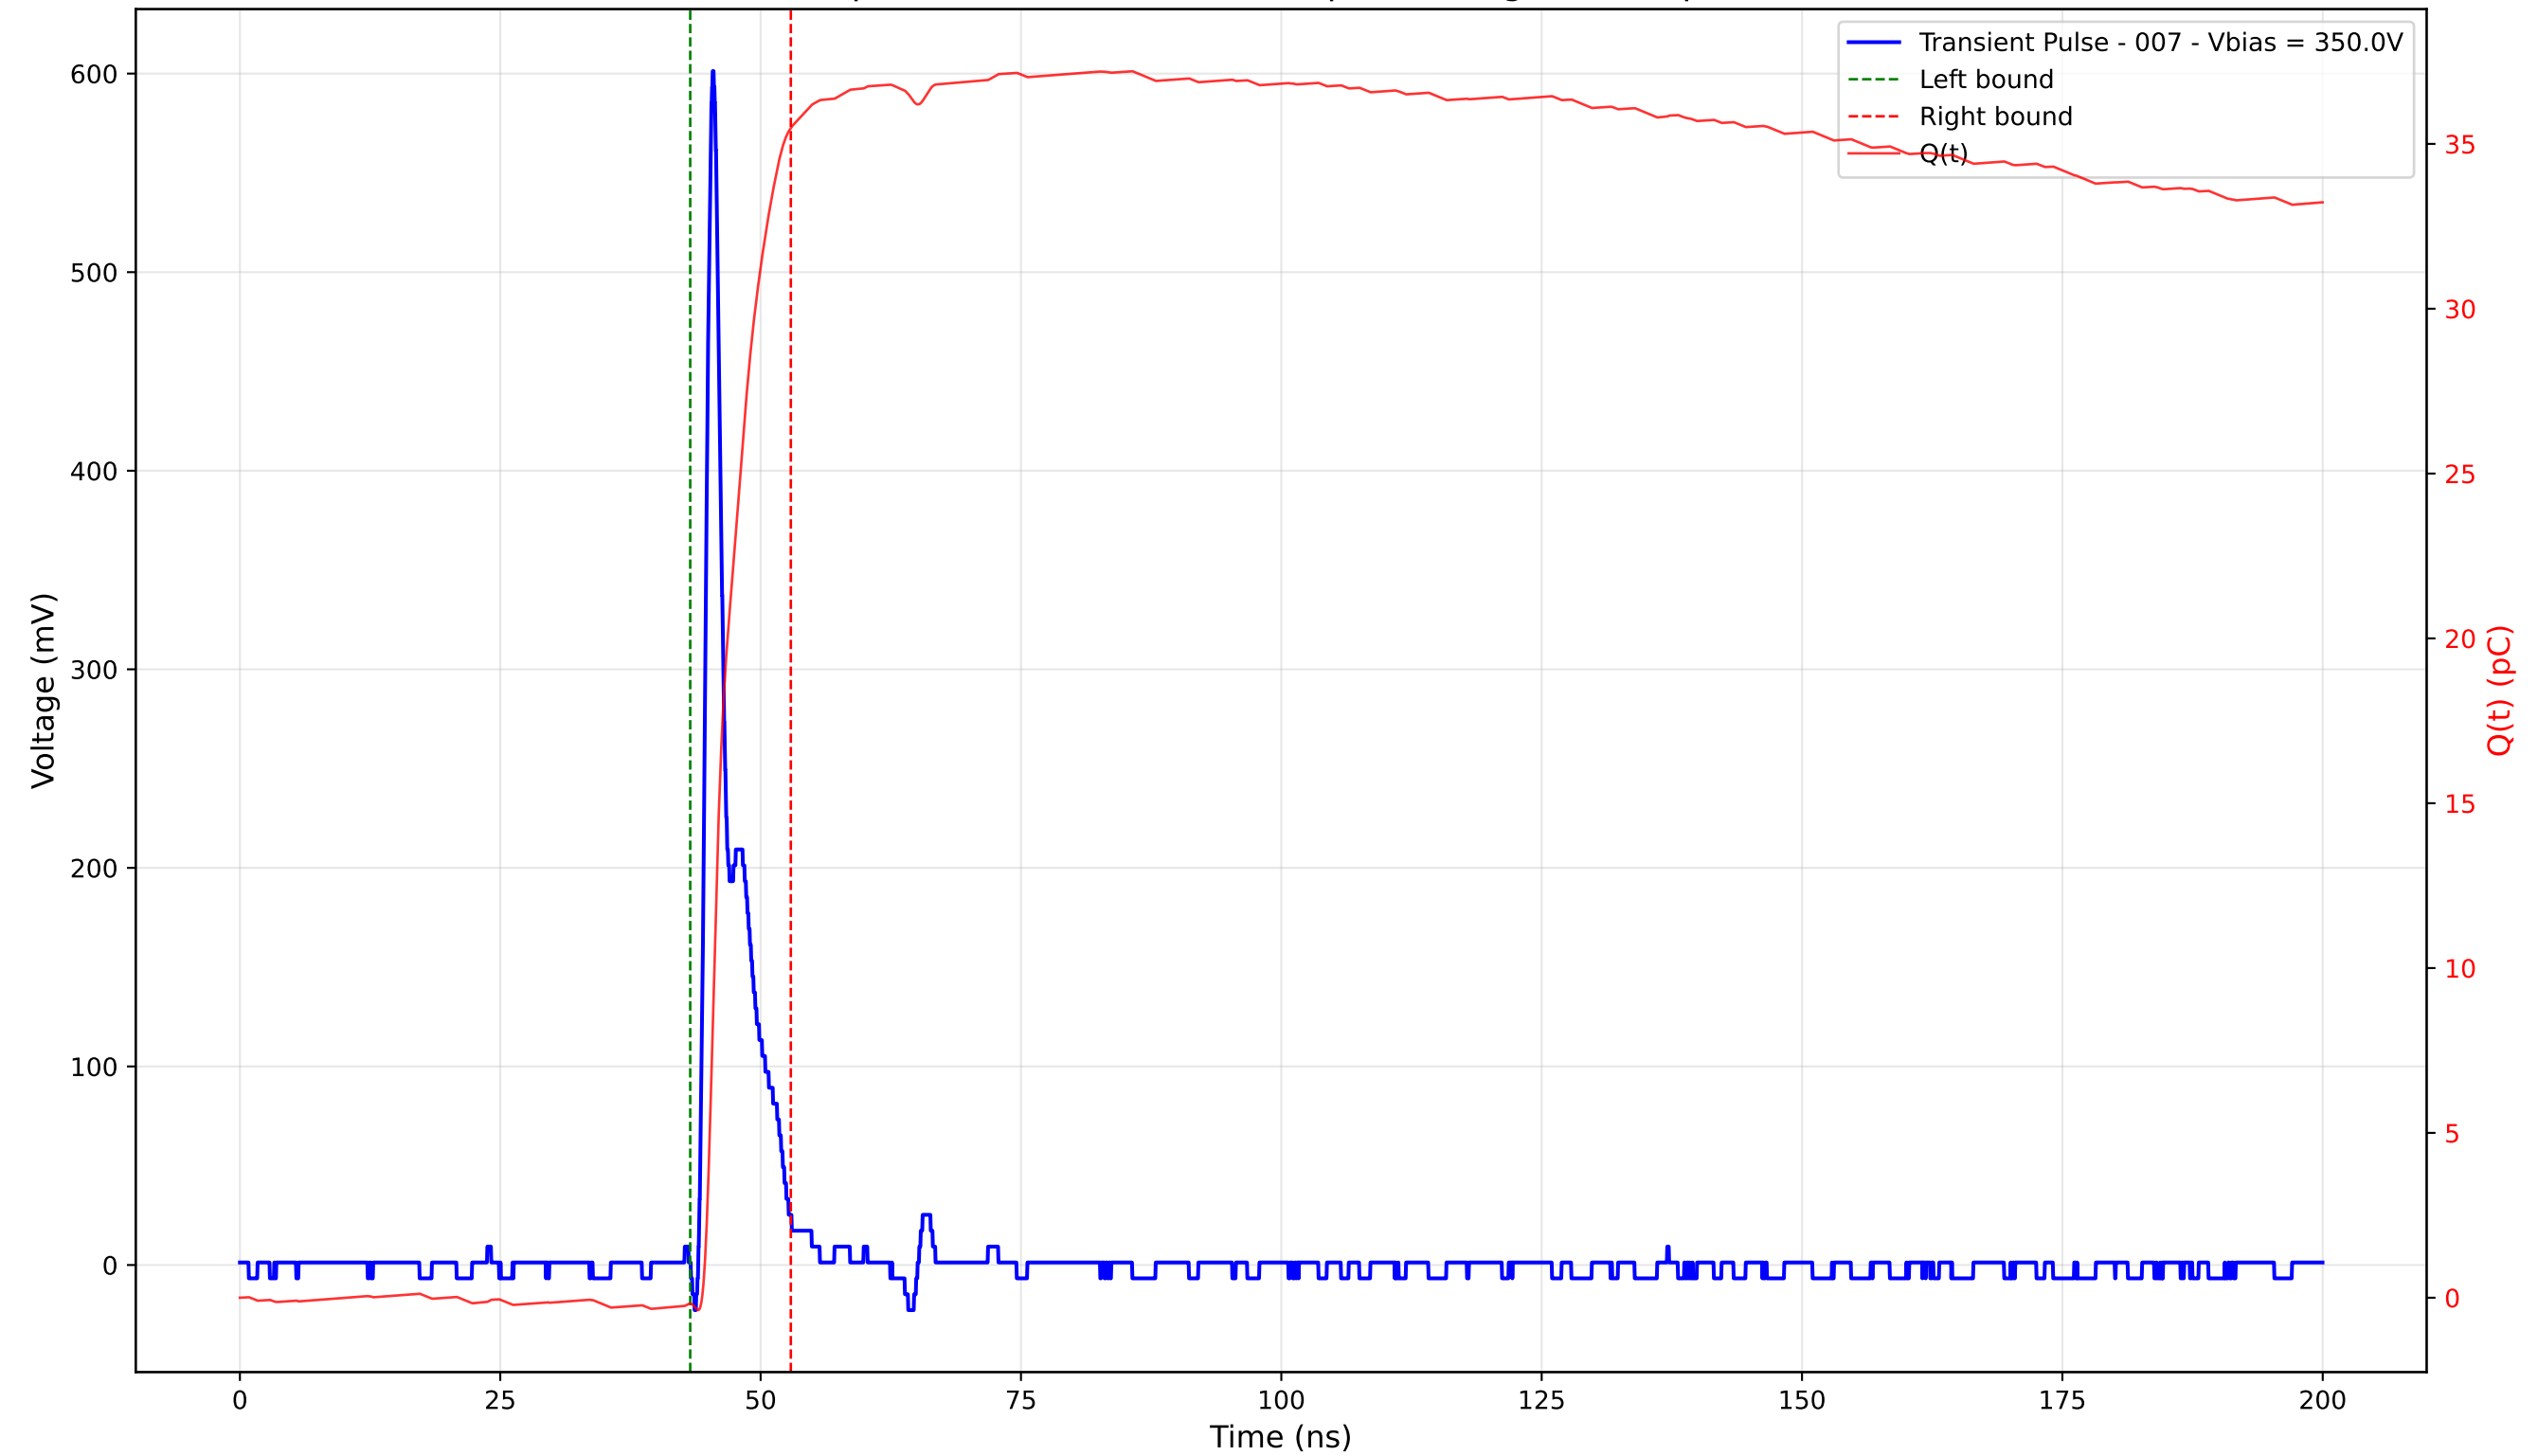


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 36.35 pC - Rise Time: 0.90 ns

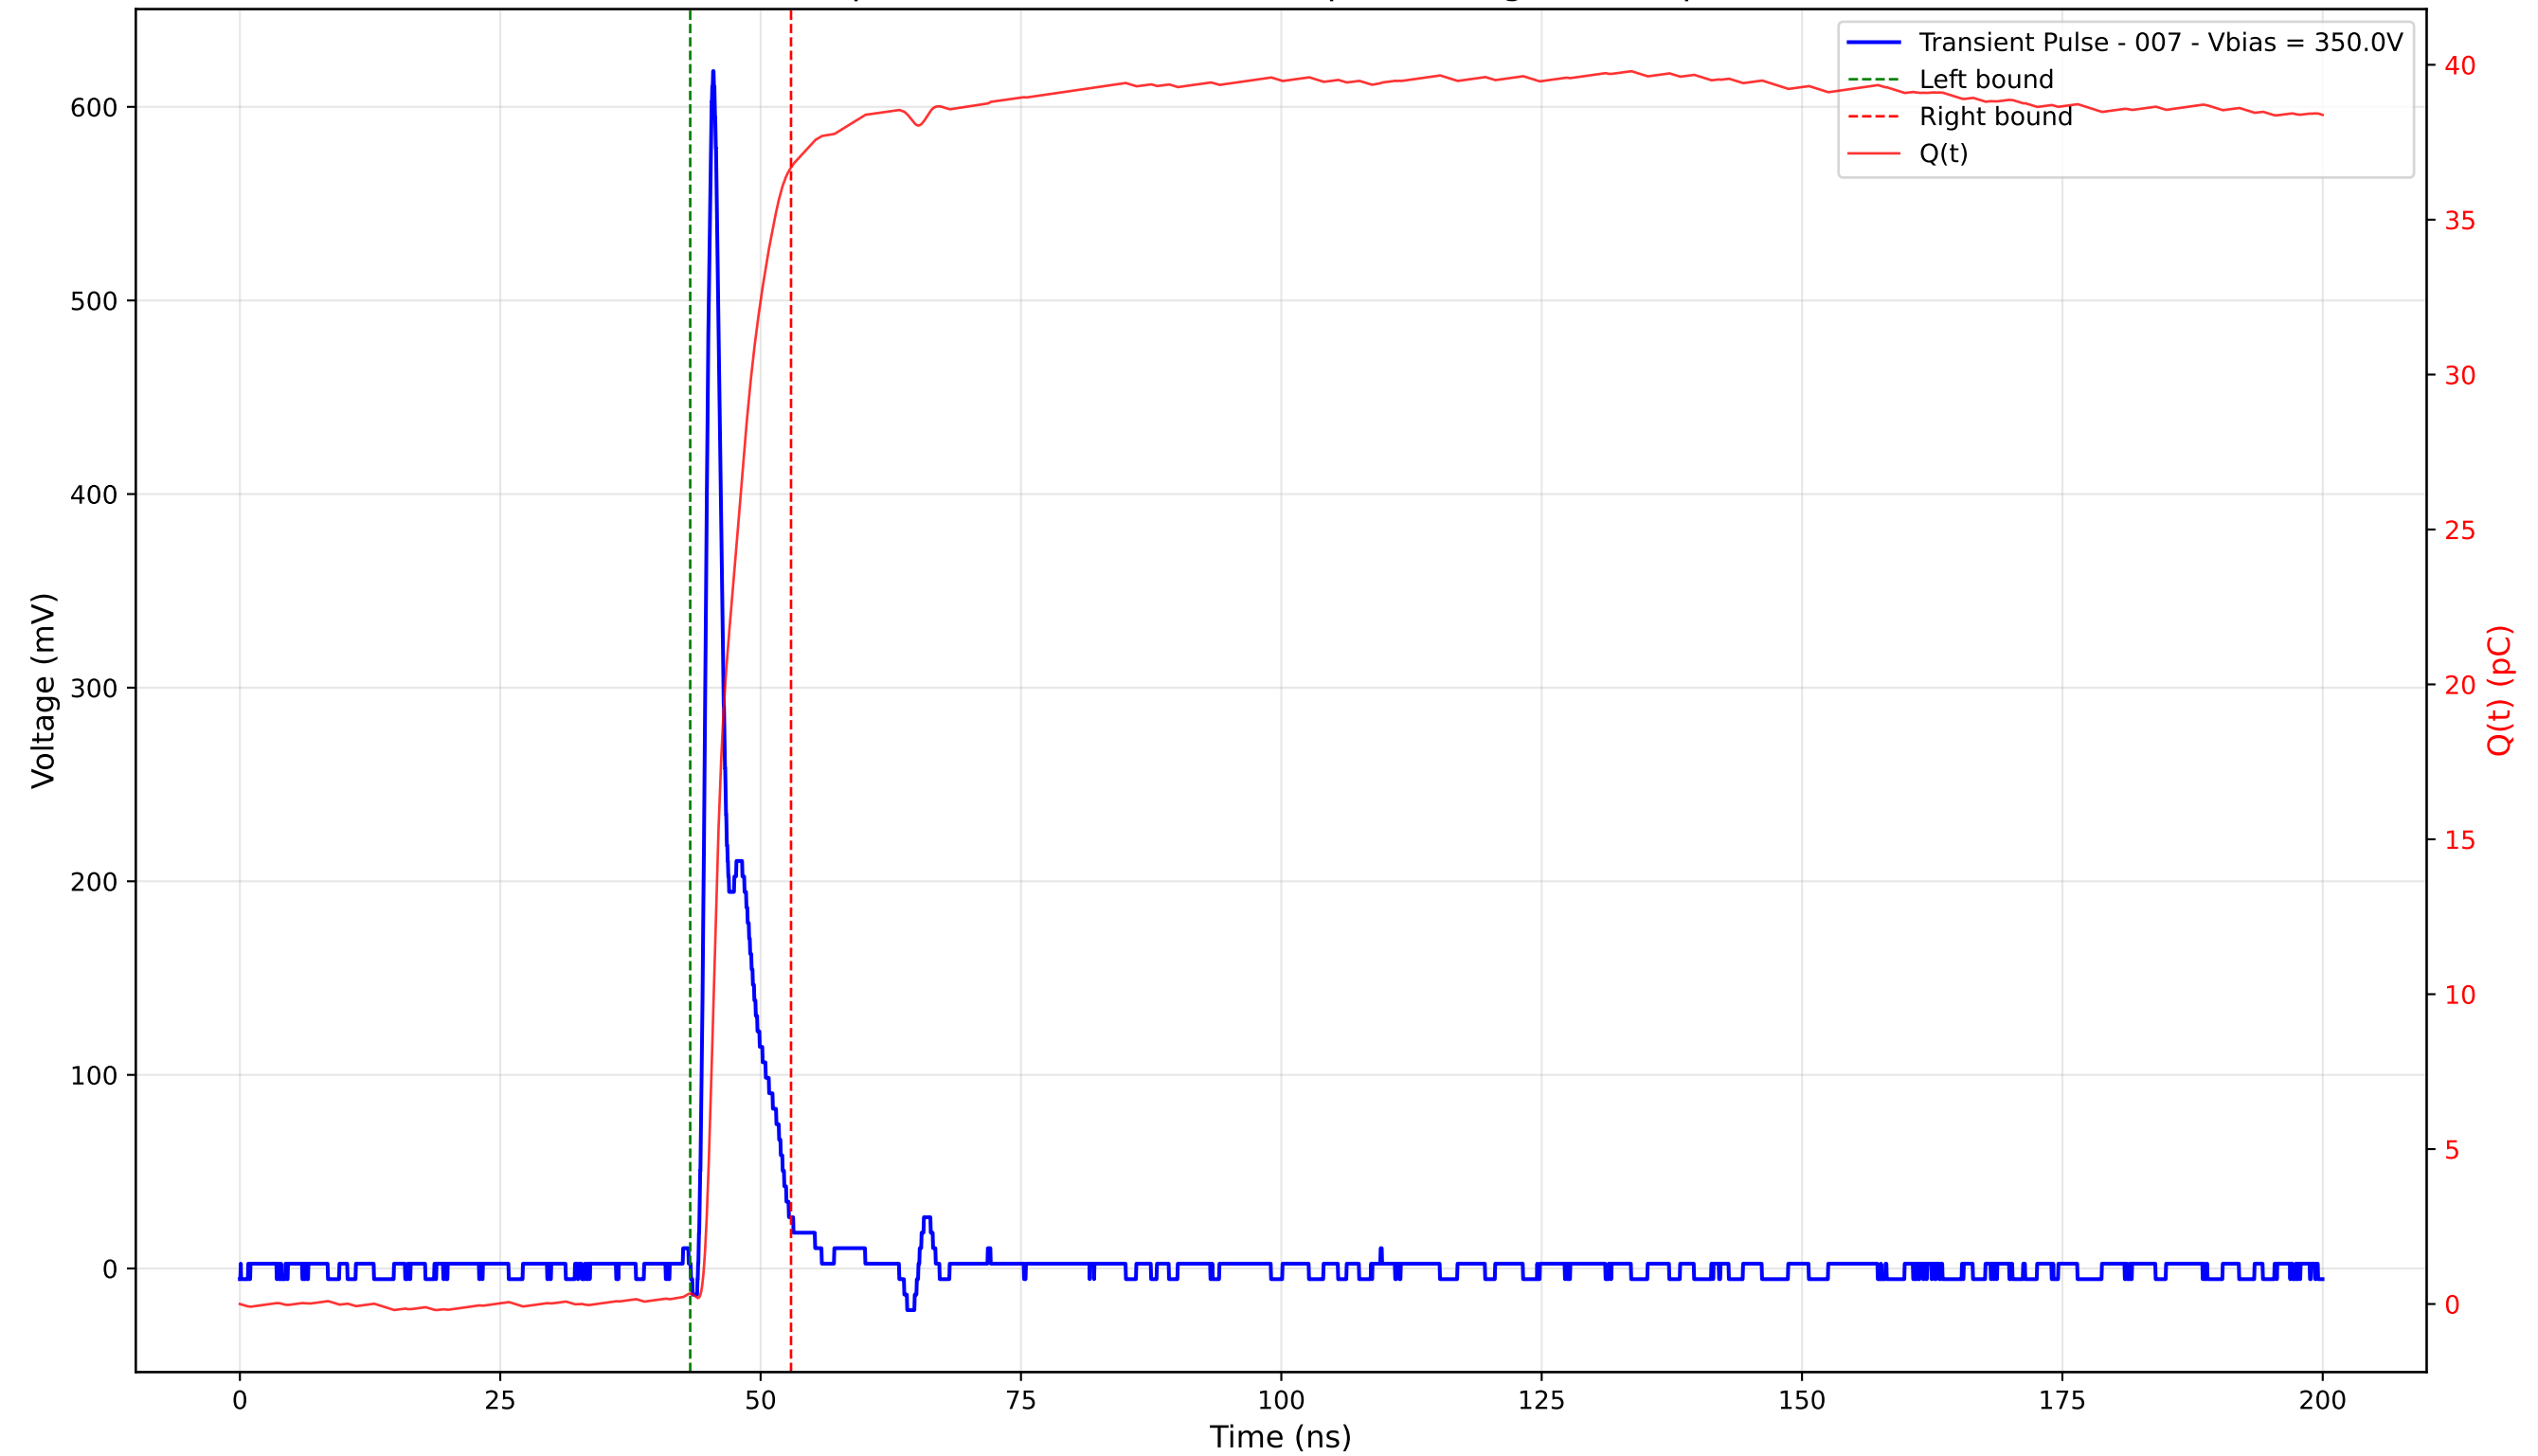


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 36.03 pC - Rise Time: 0.89 ns

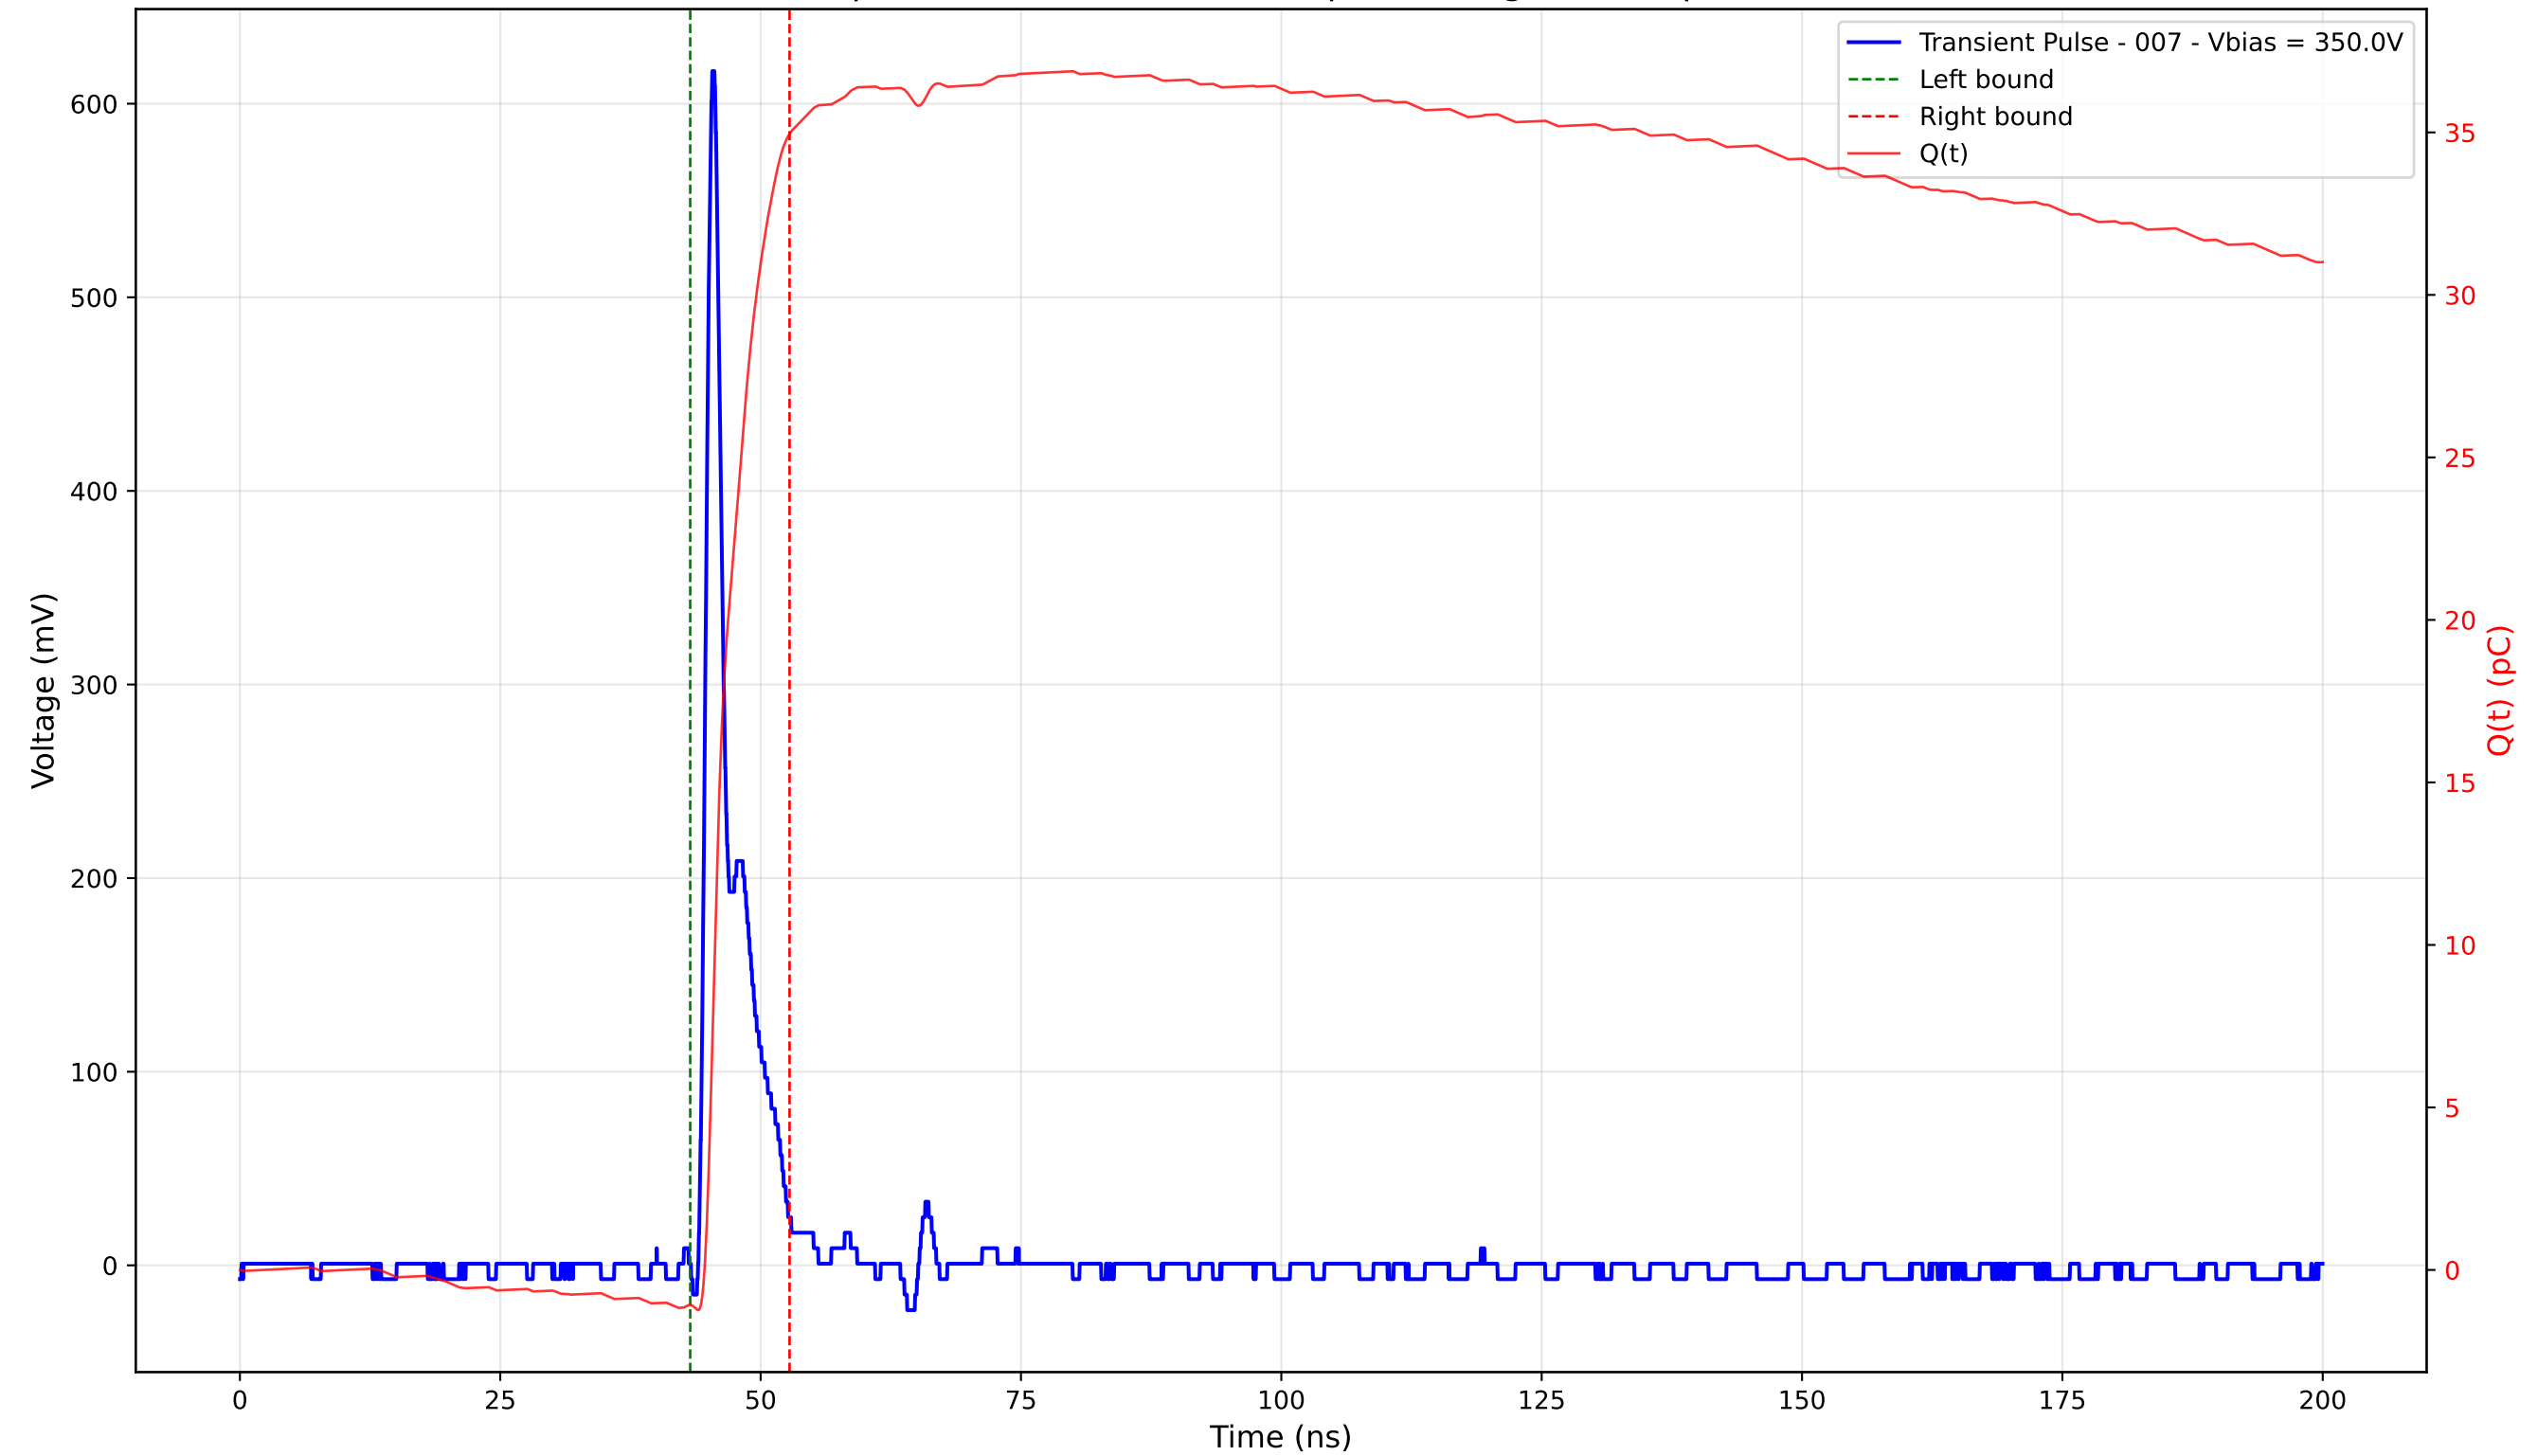


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 35.95 pC - Rise Time: 0.91 ns

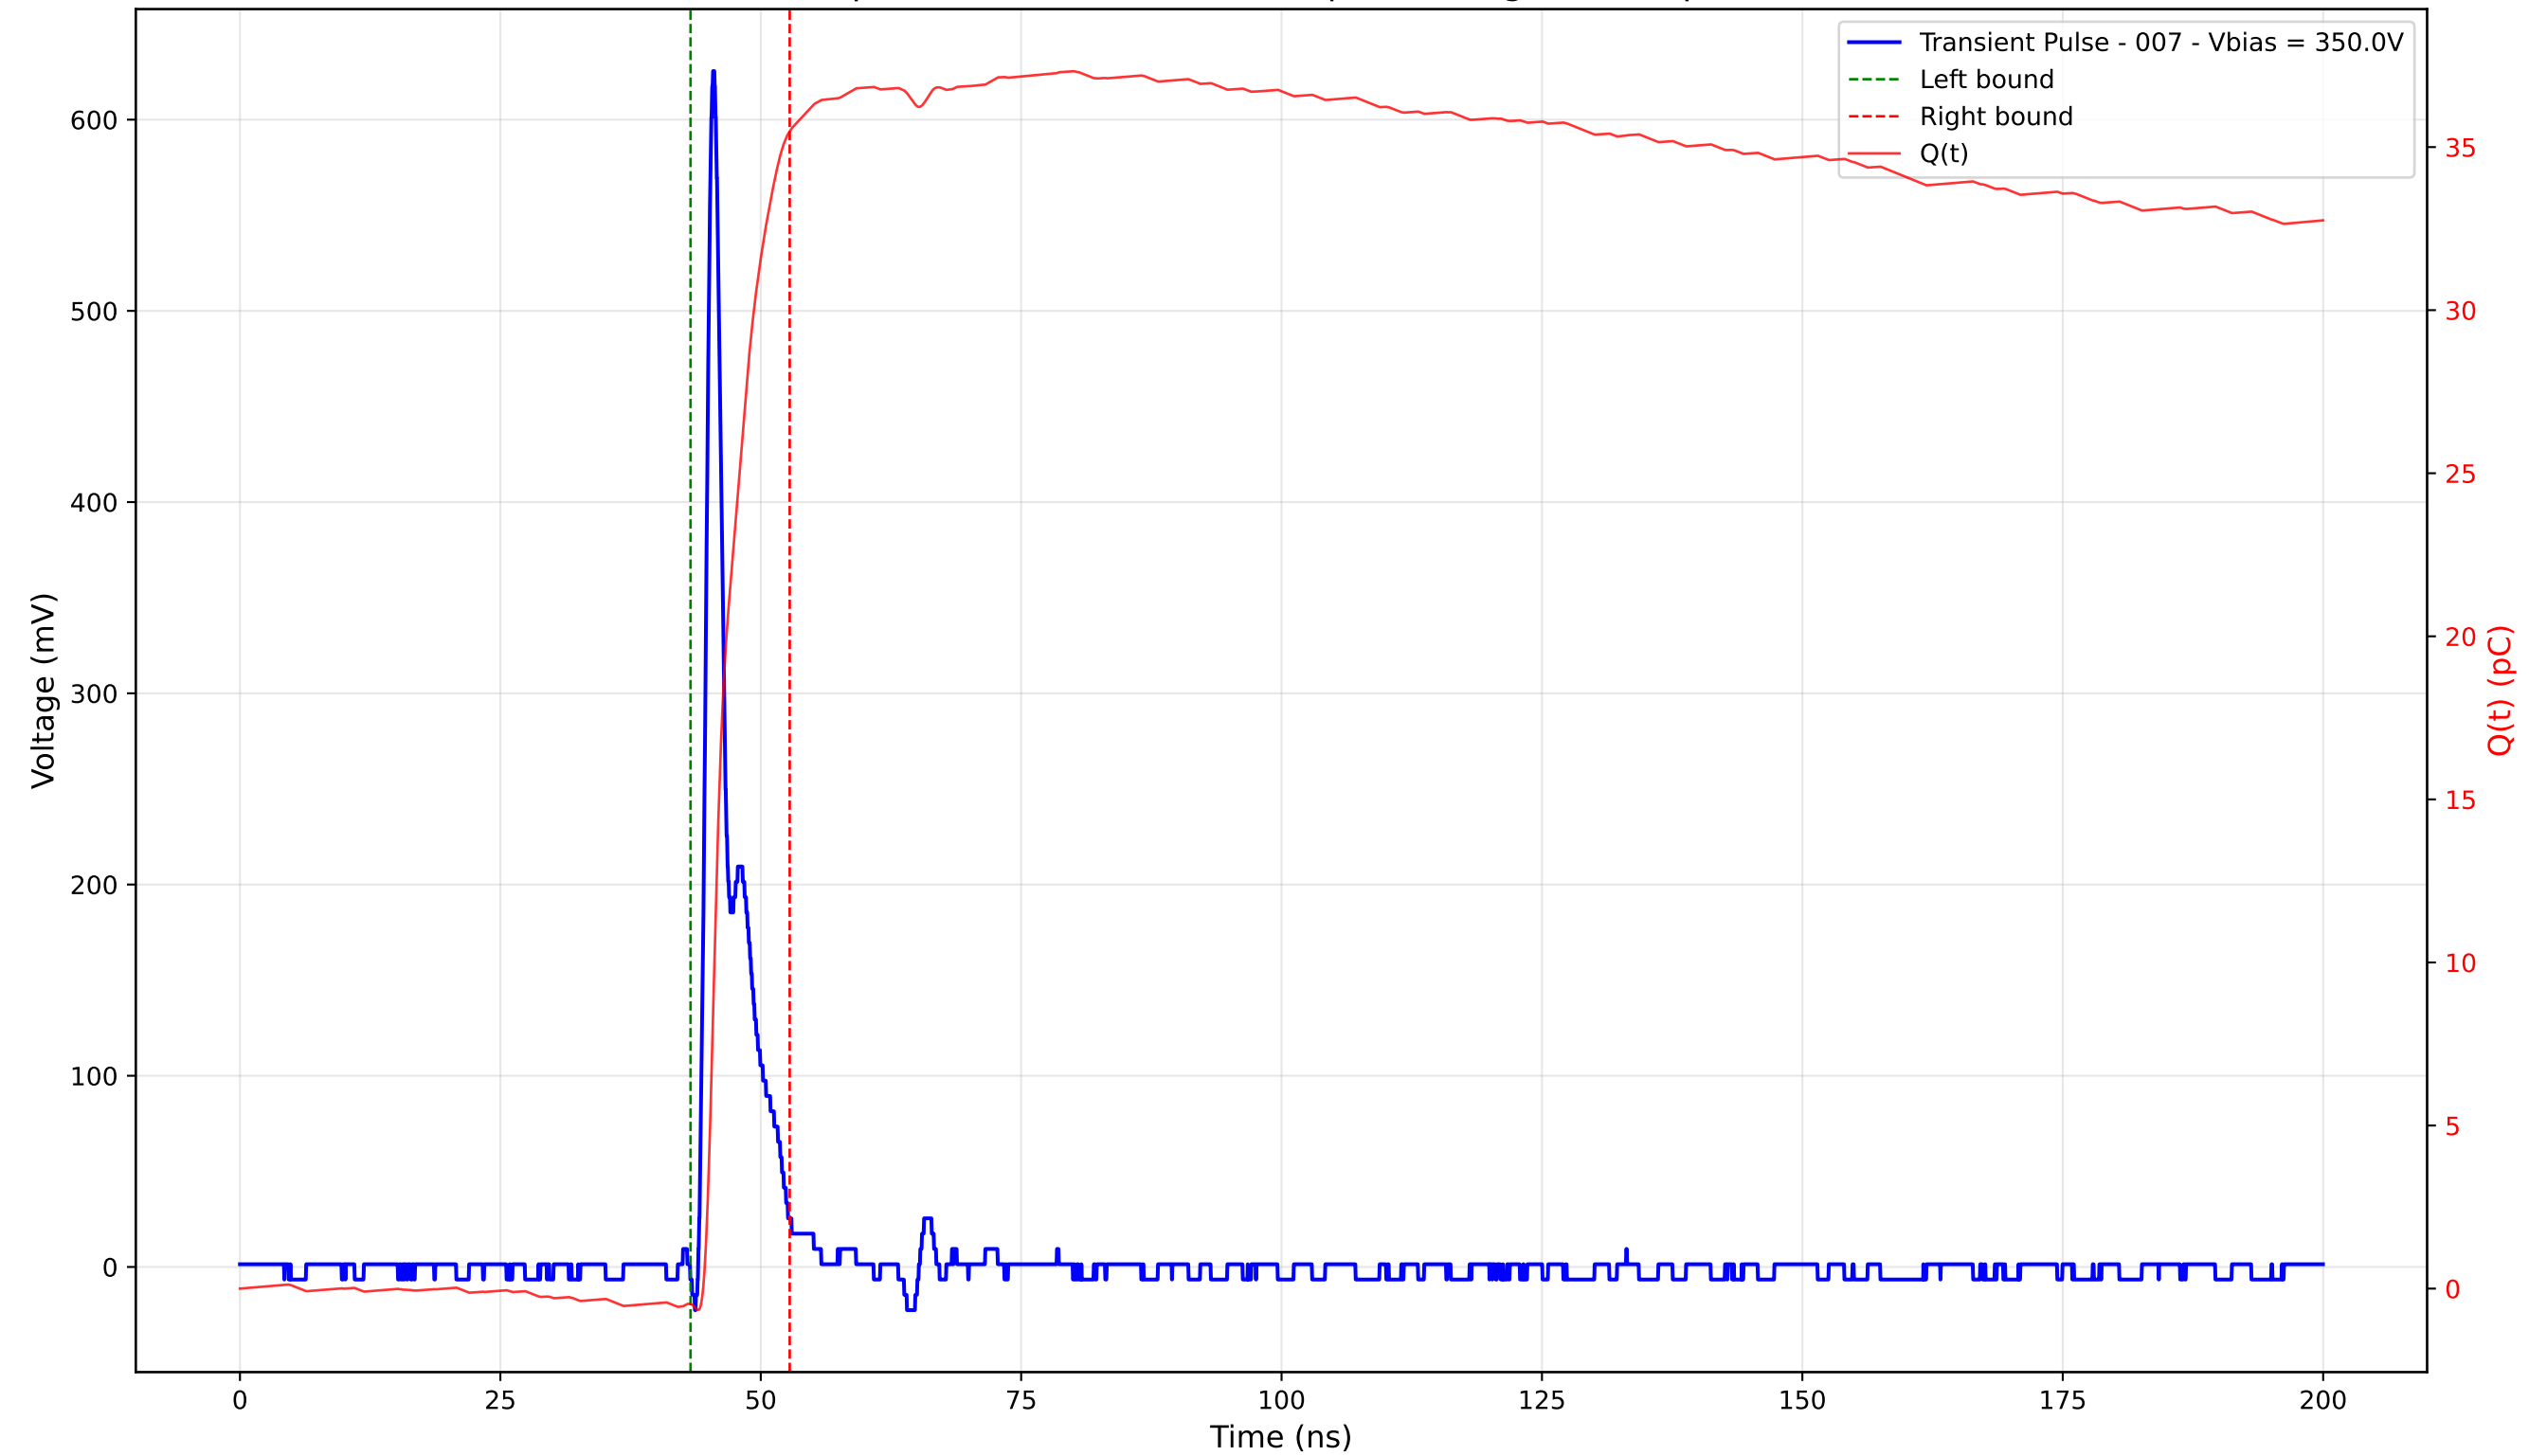


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 36.48 pC - Rise Time: 0.91 ns

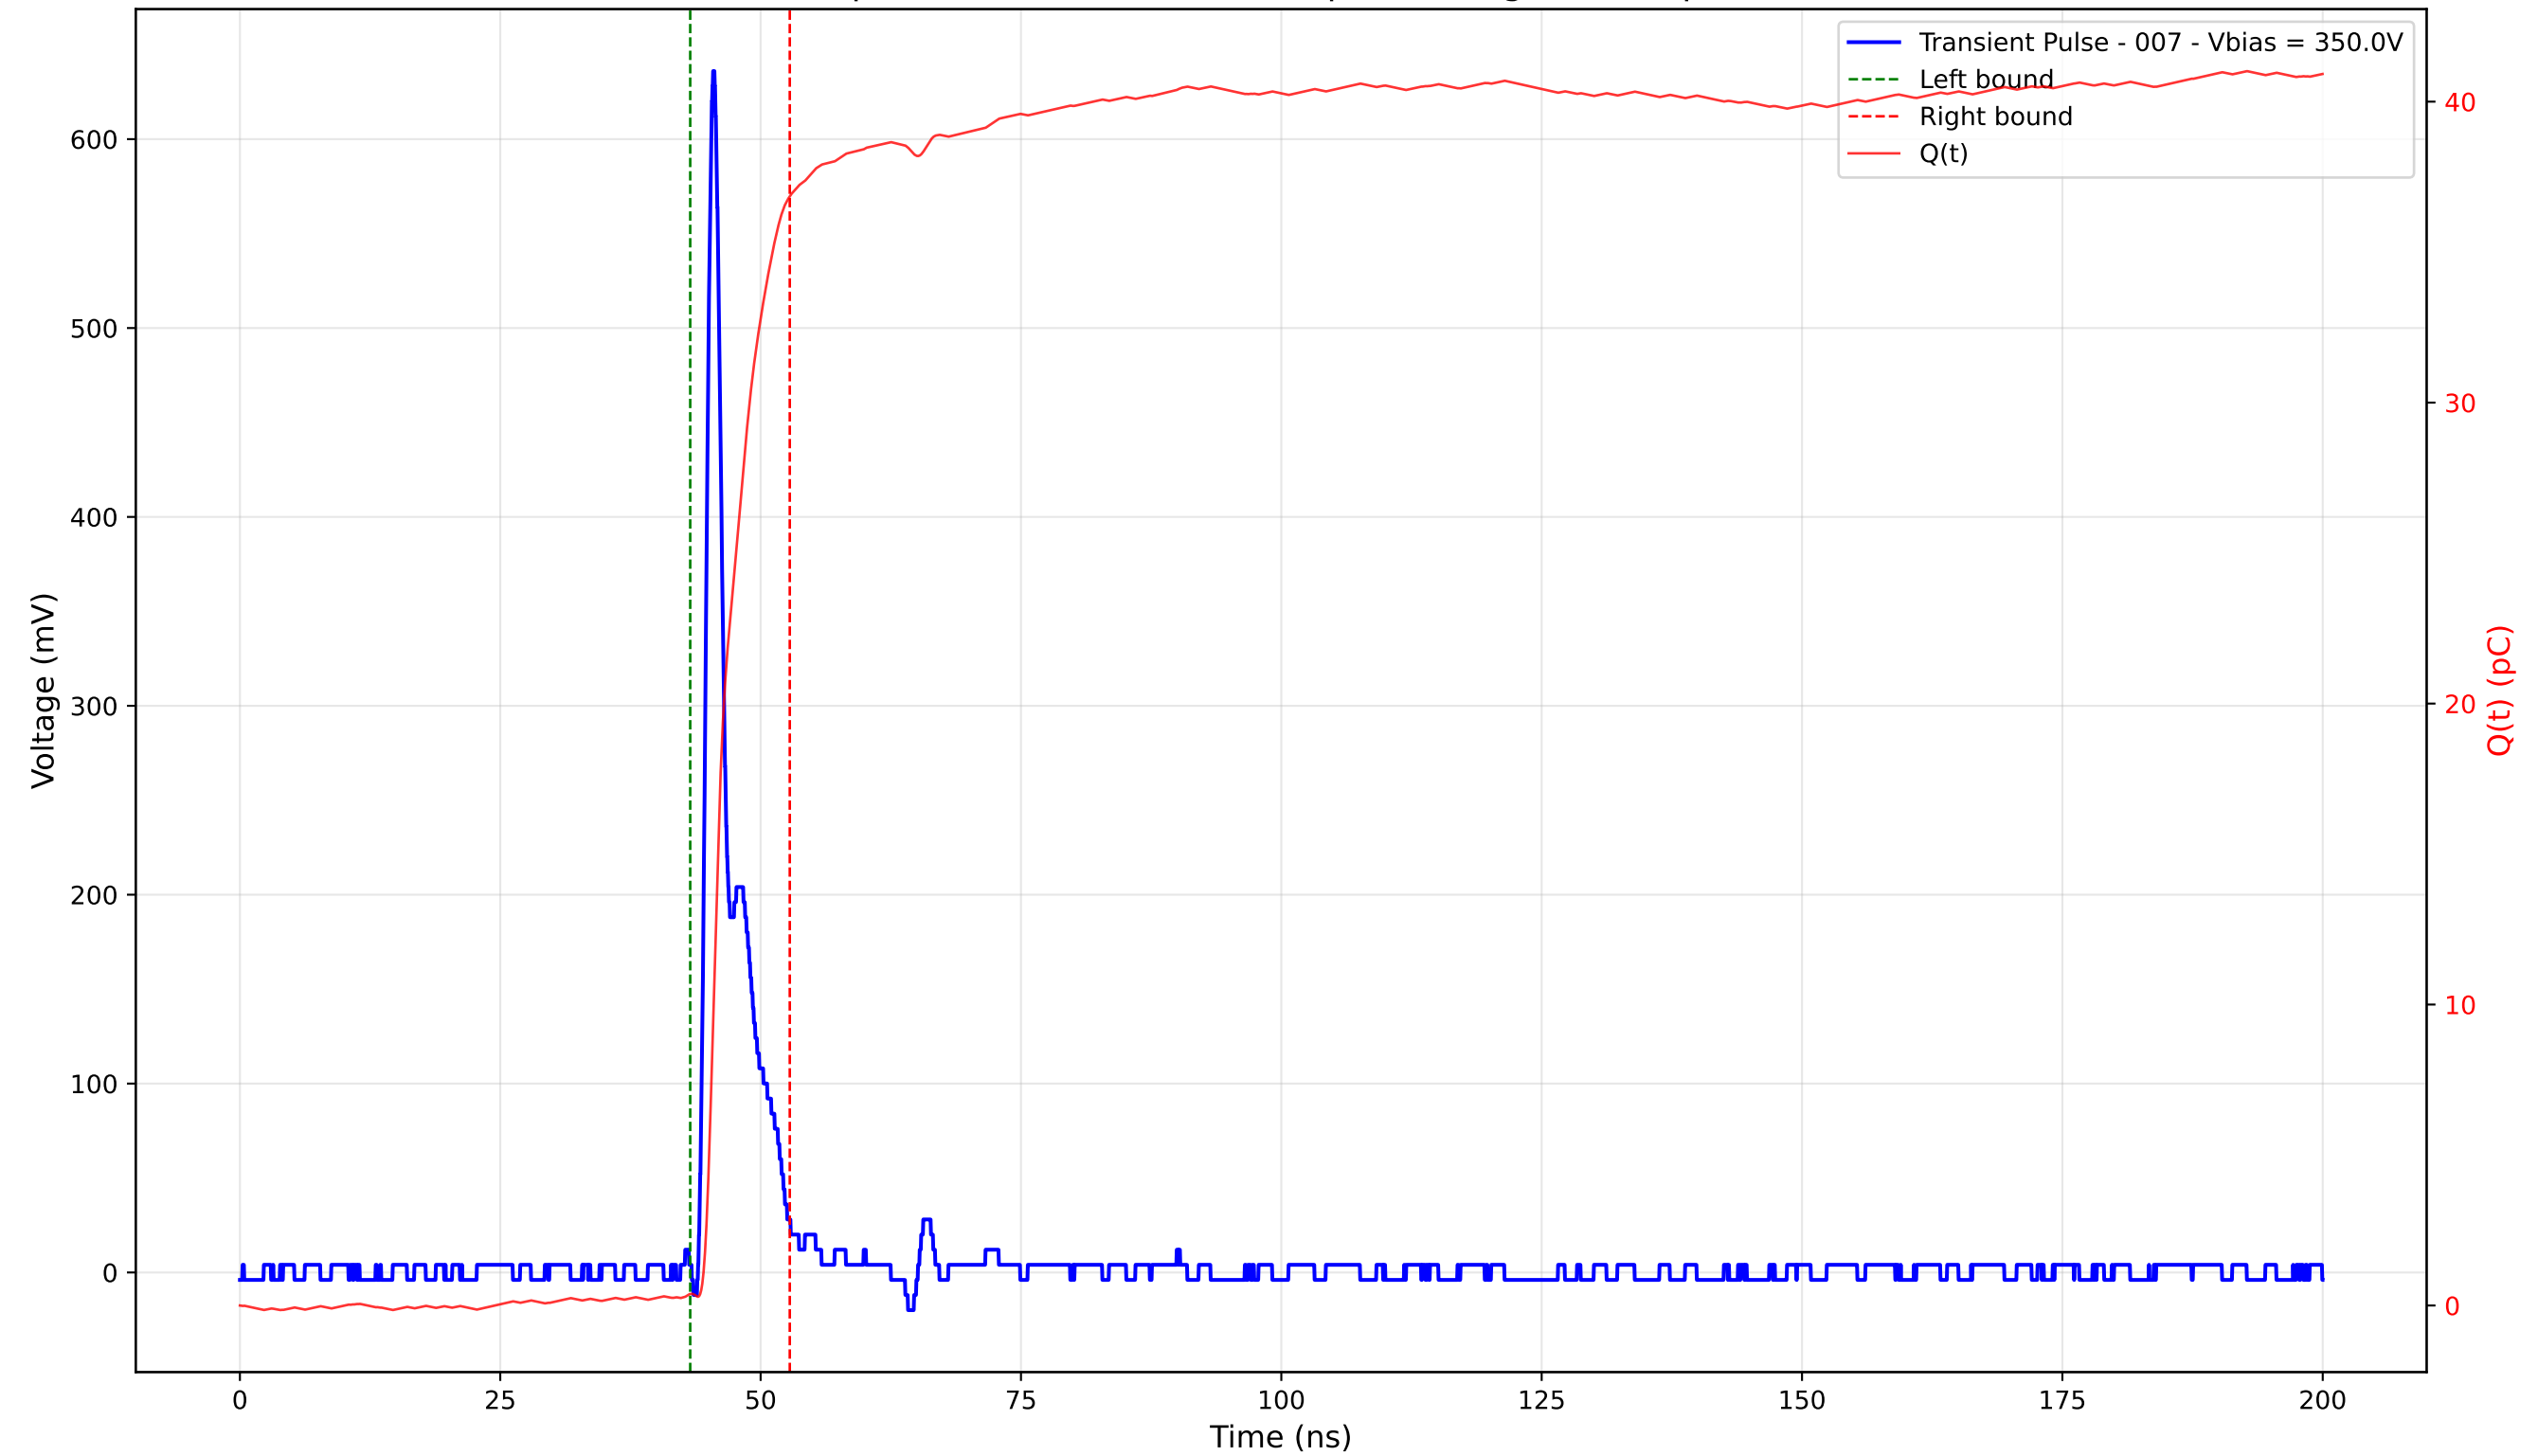


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 35.52 pC - Rise Time: 0.91 ns

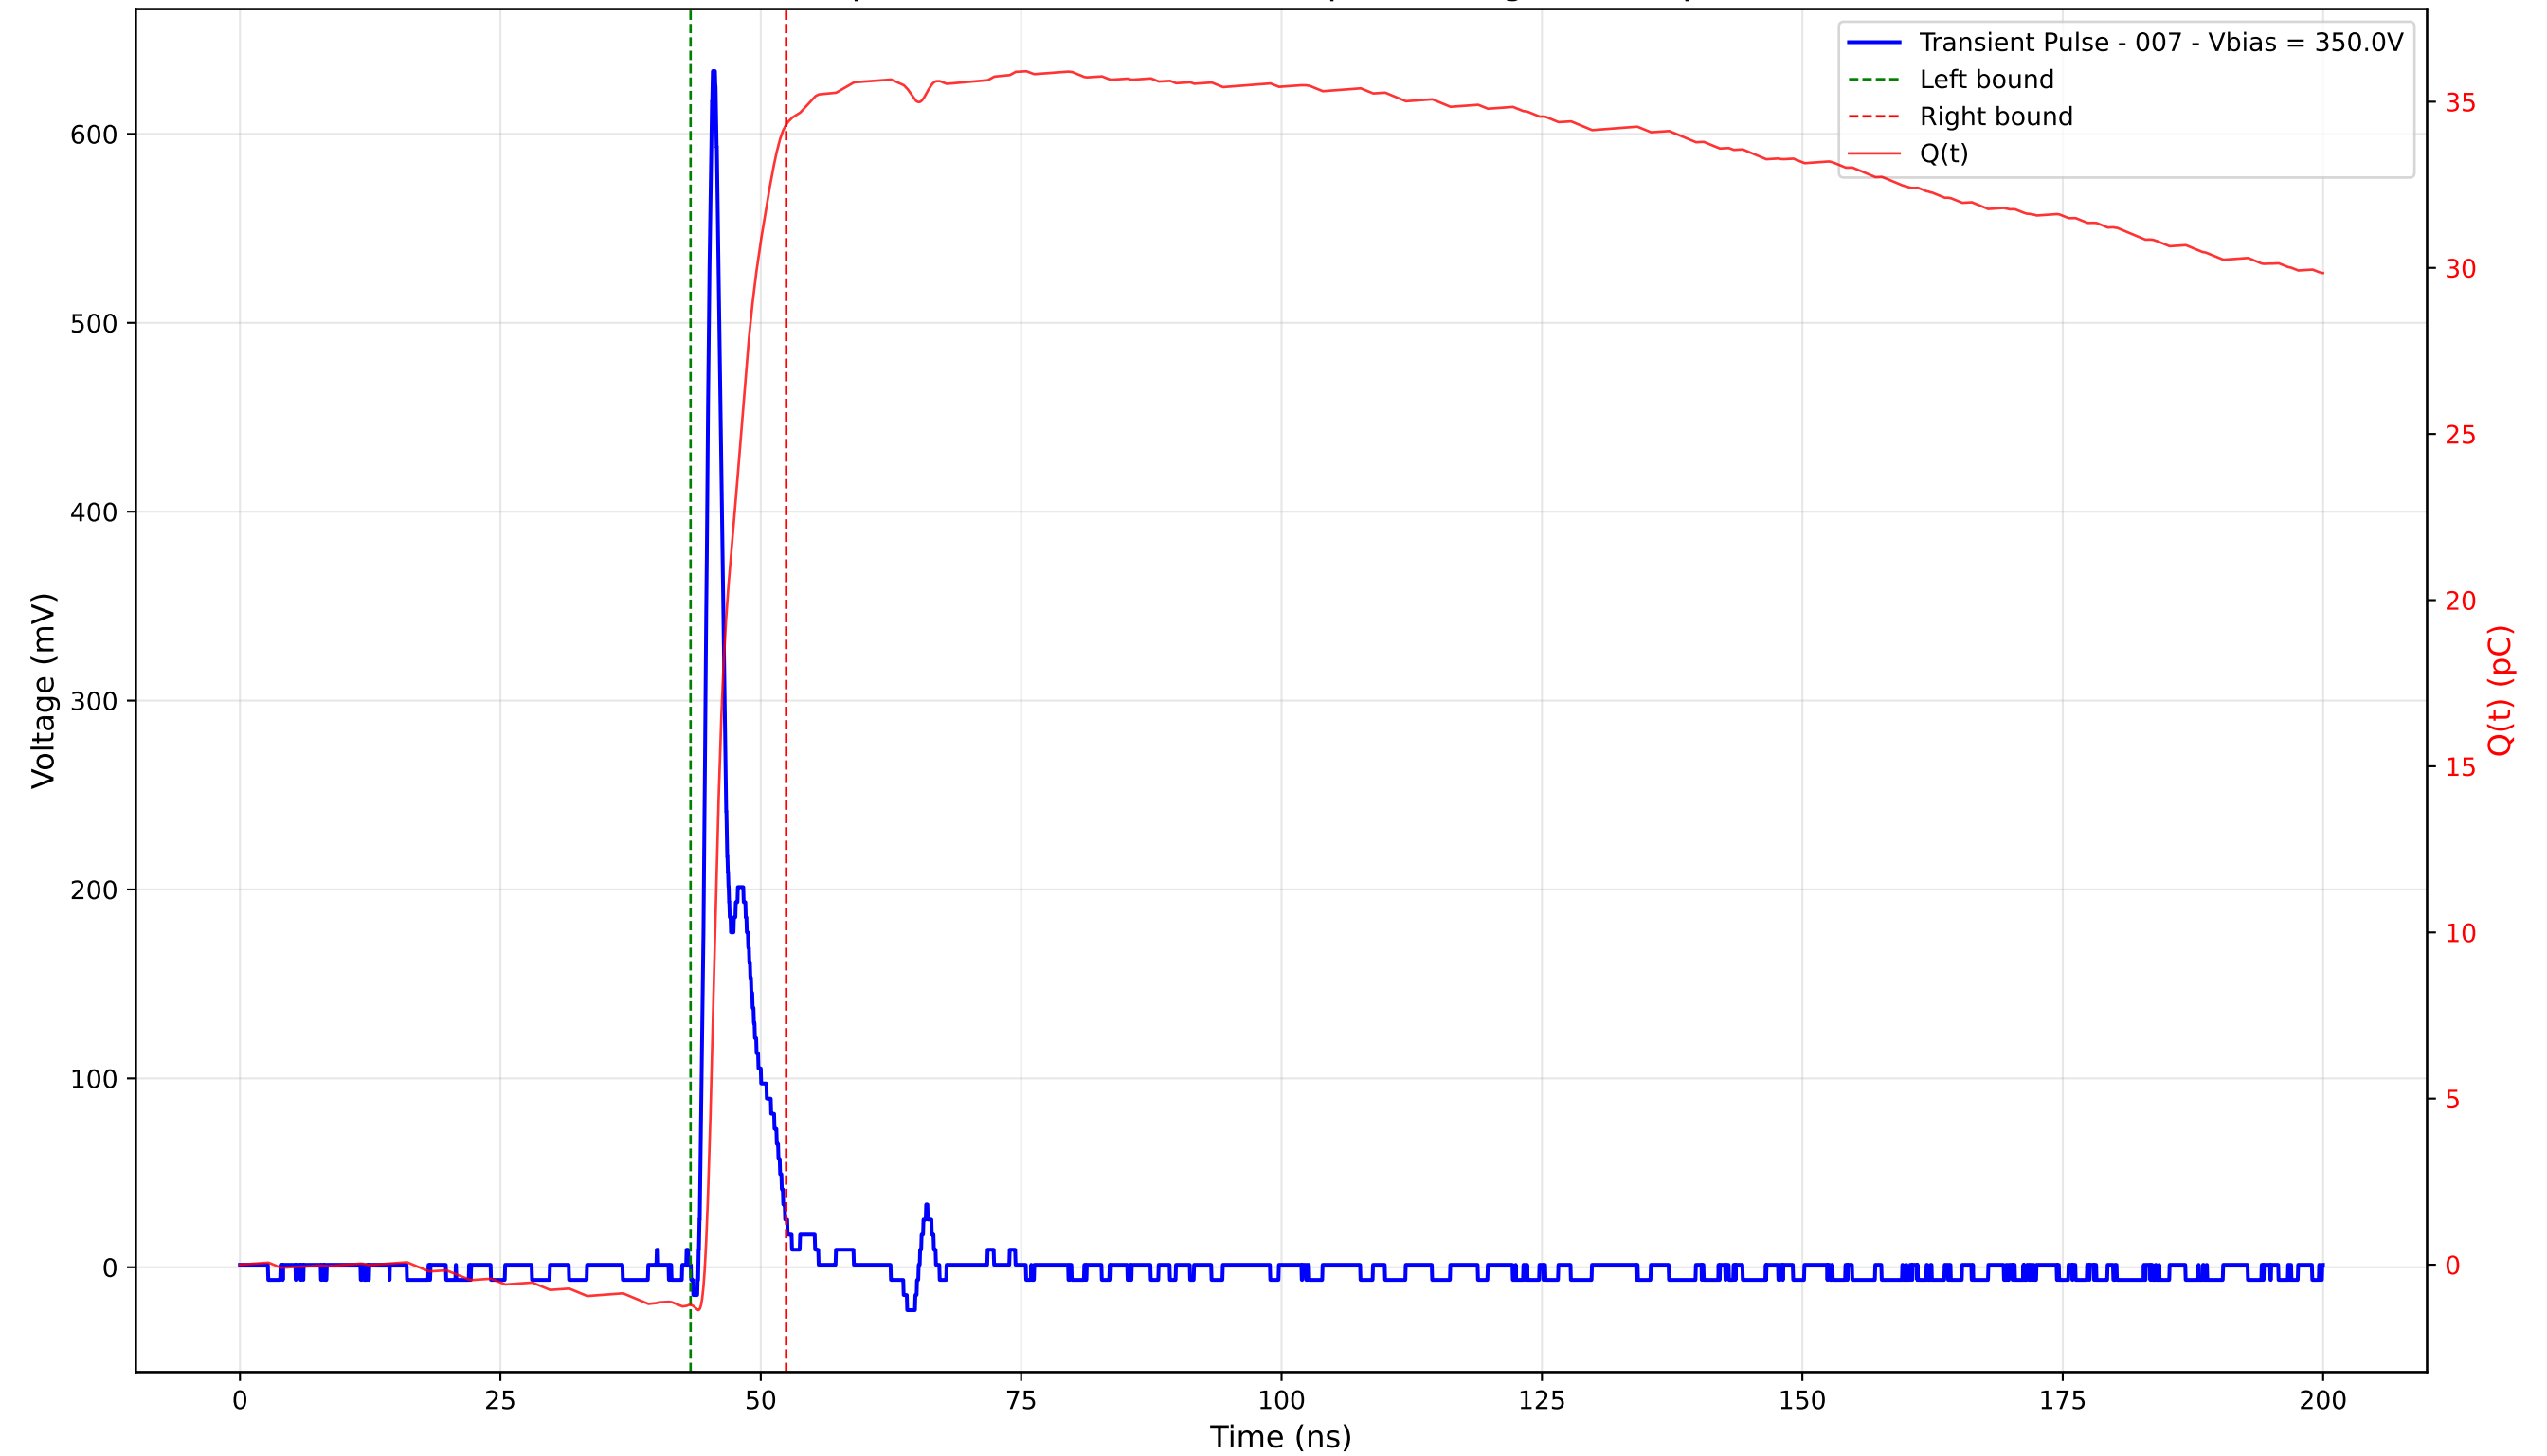


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 35.71 pC - Rise Time: 0.92 ns

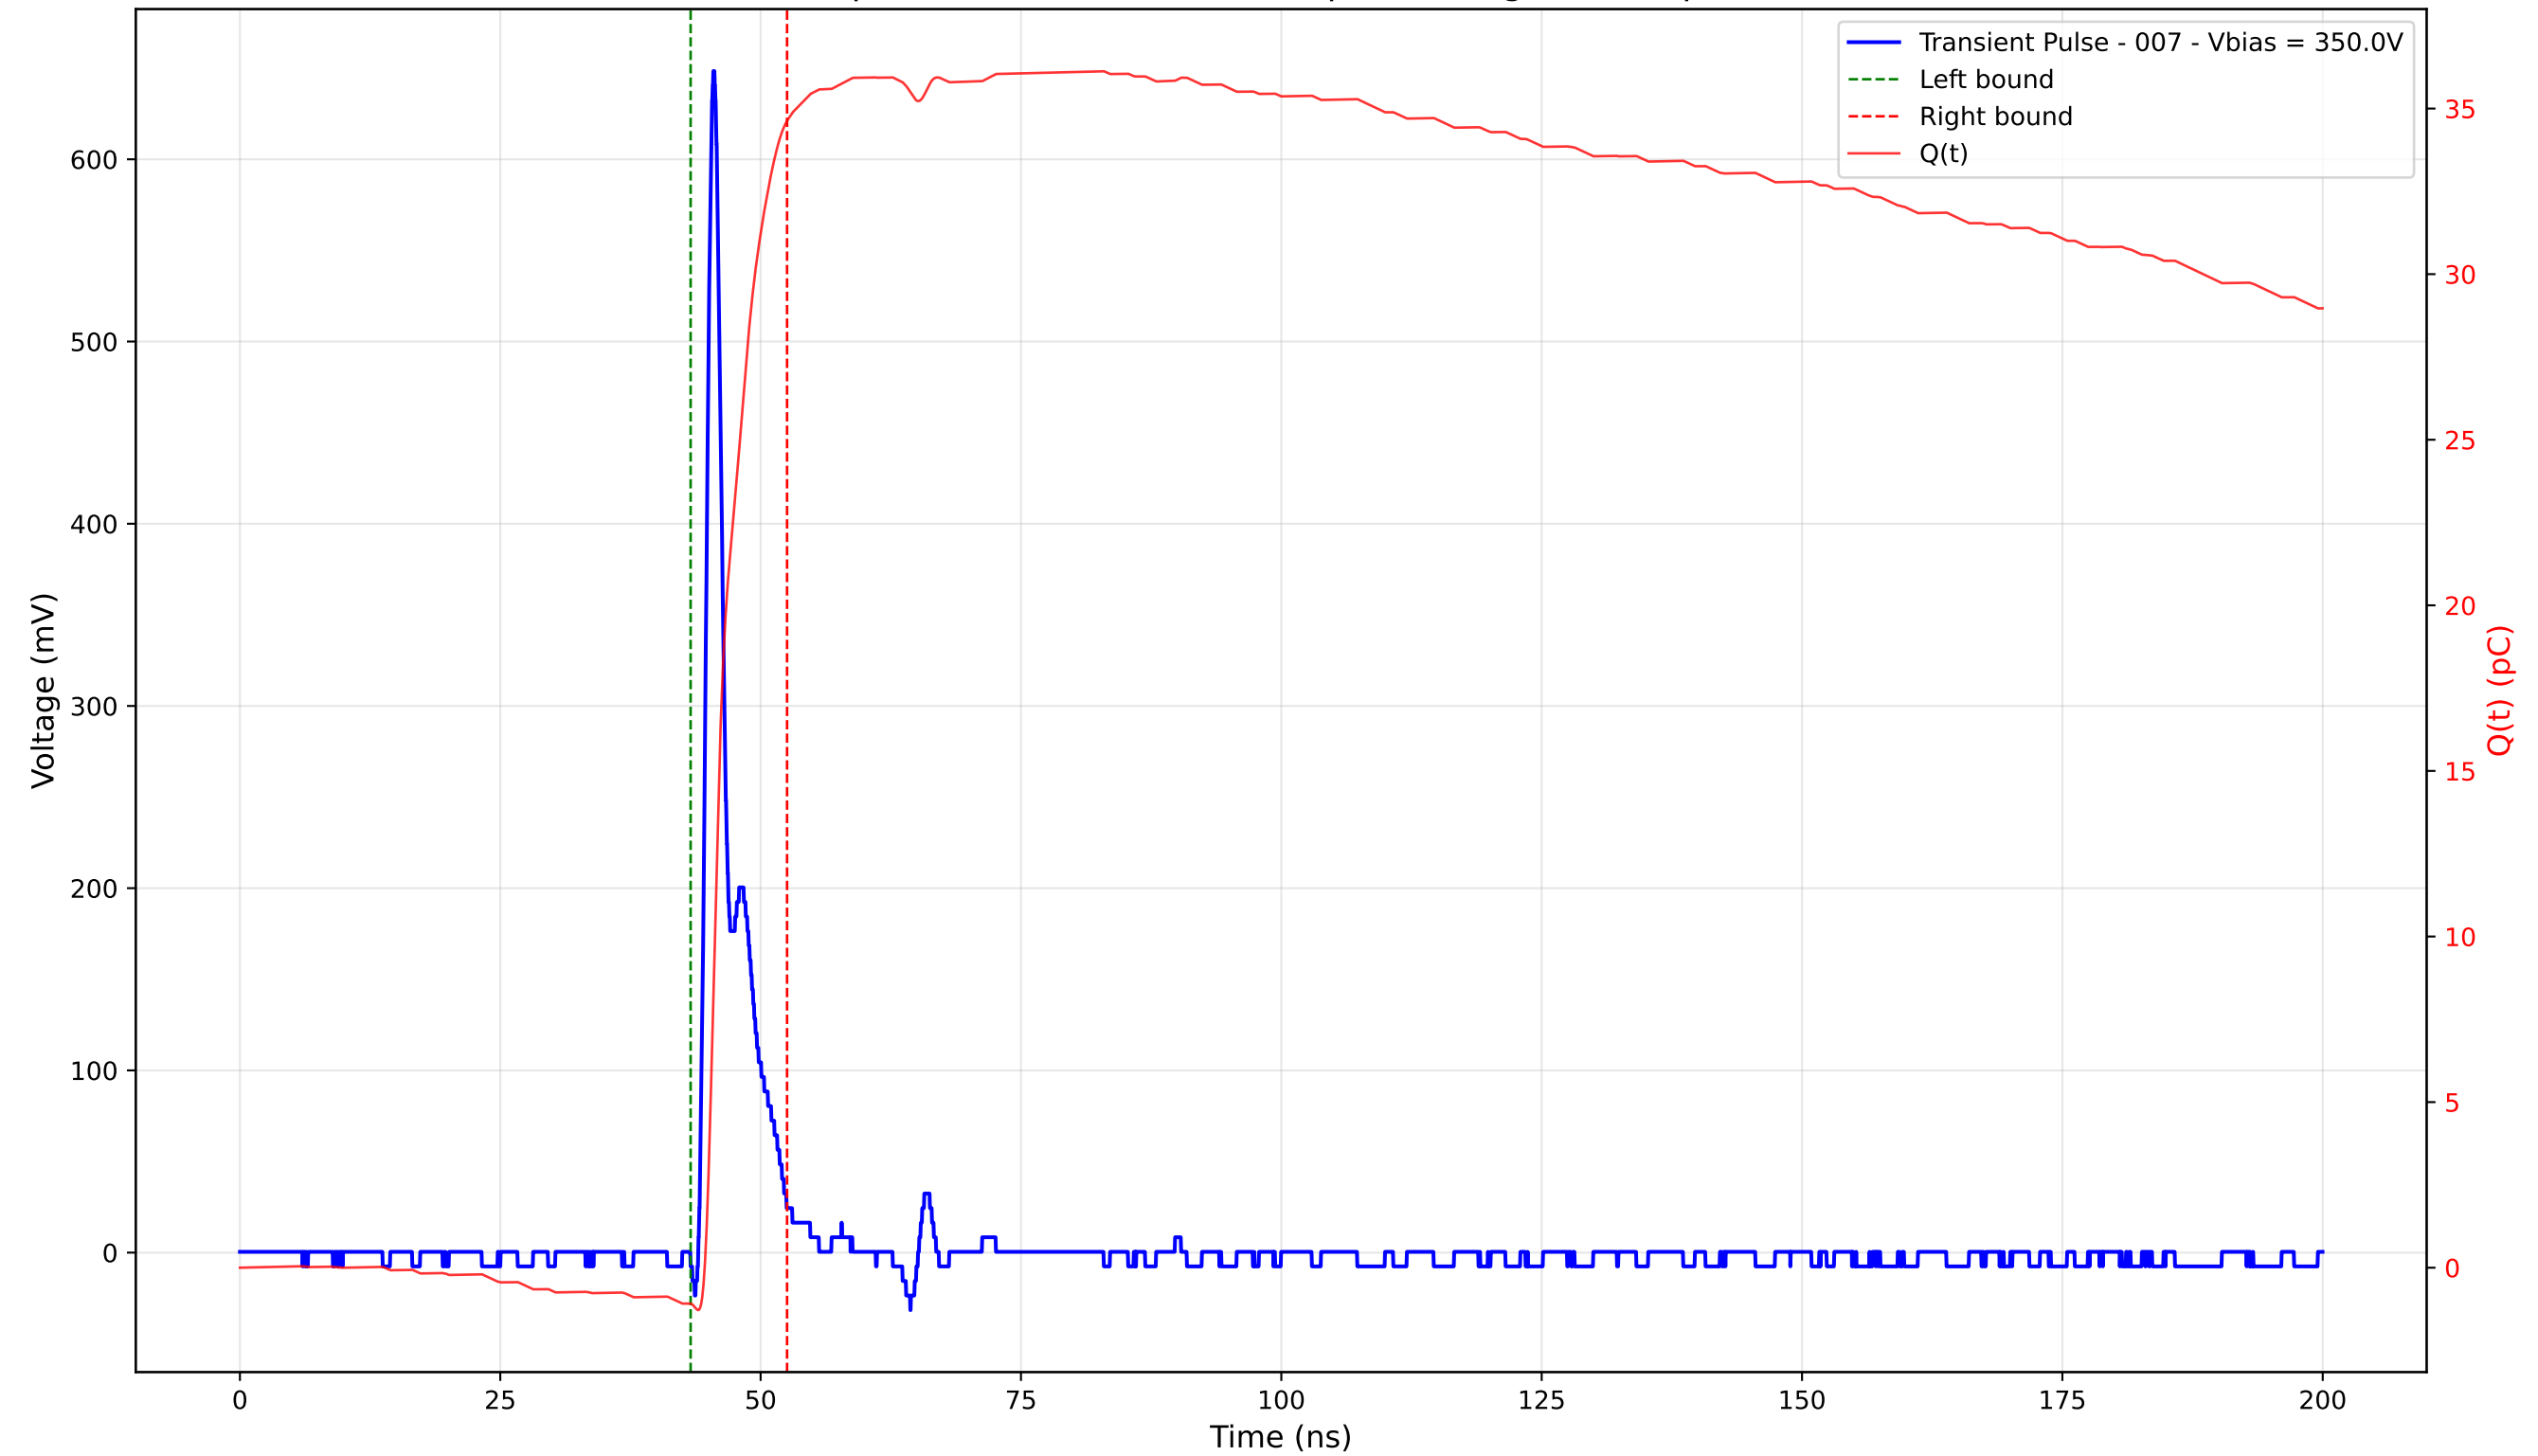


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 35.82 pC - Rise Time: 0.94 ns

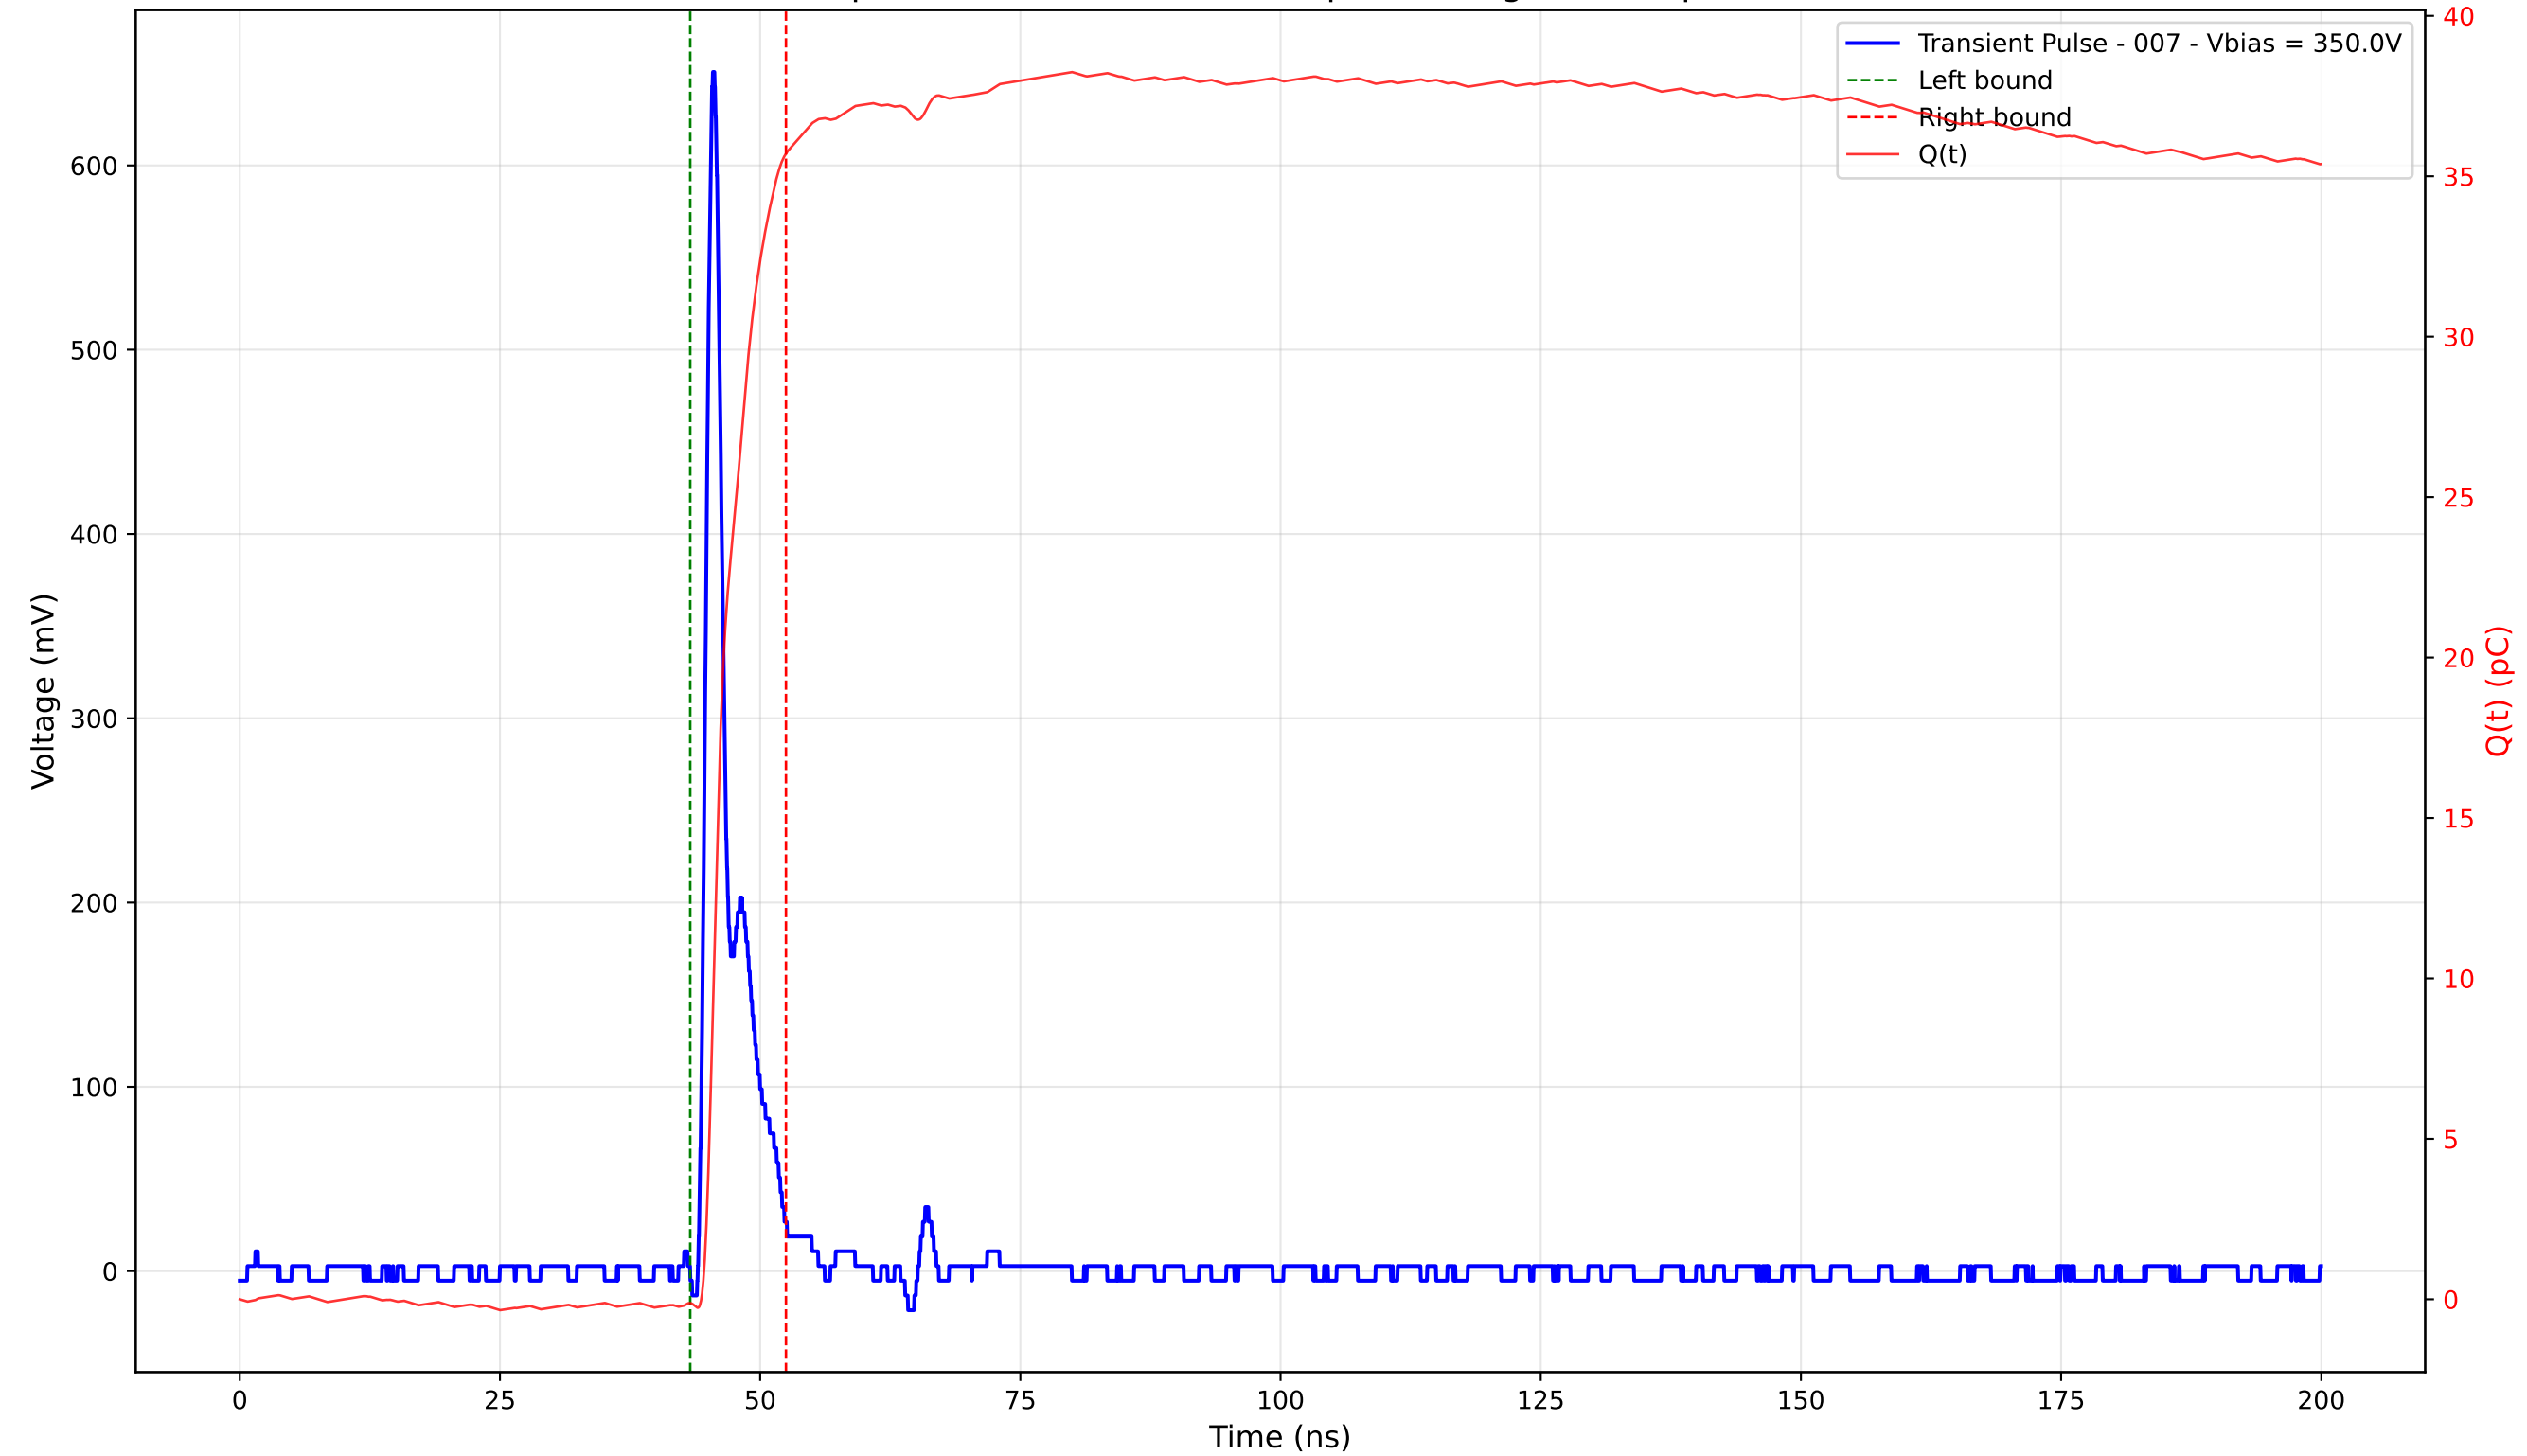


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 35.93 pC - Rise Time: 0.96 ns

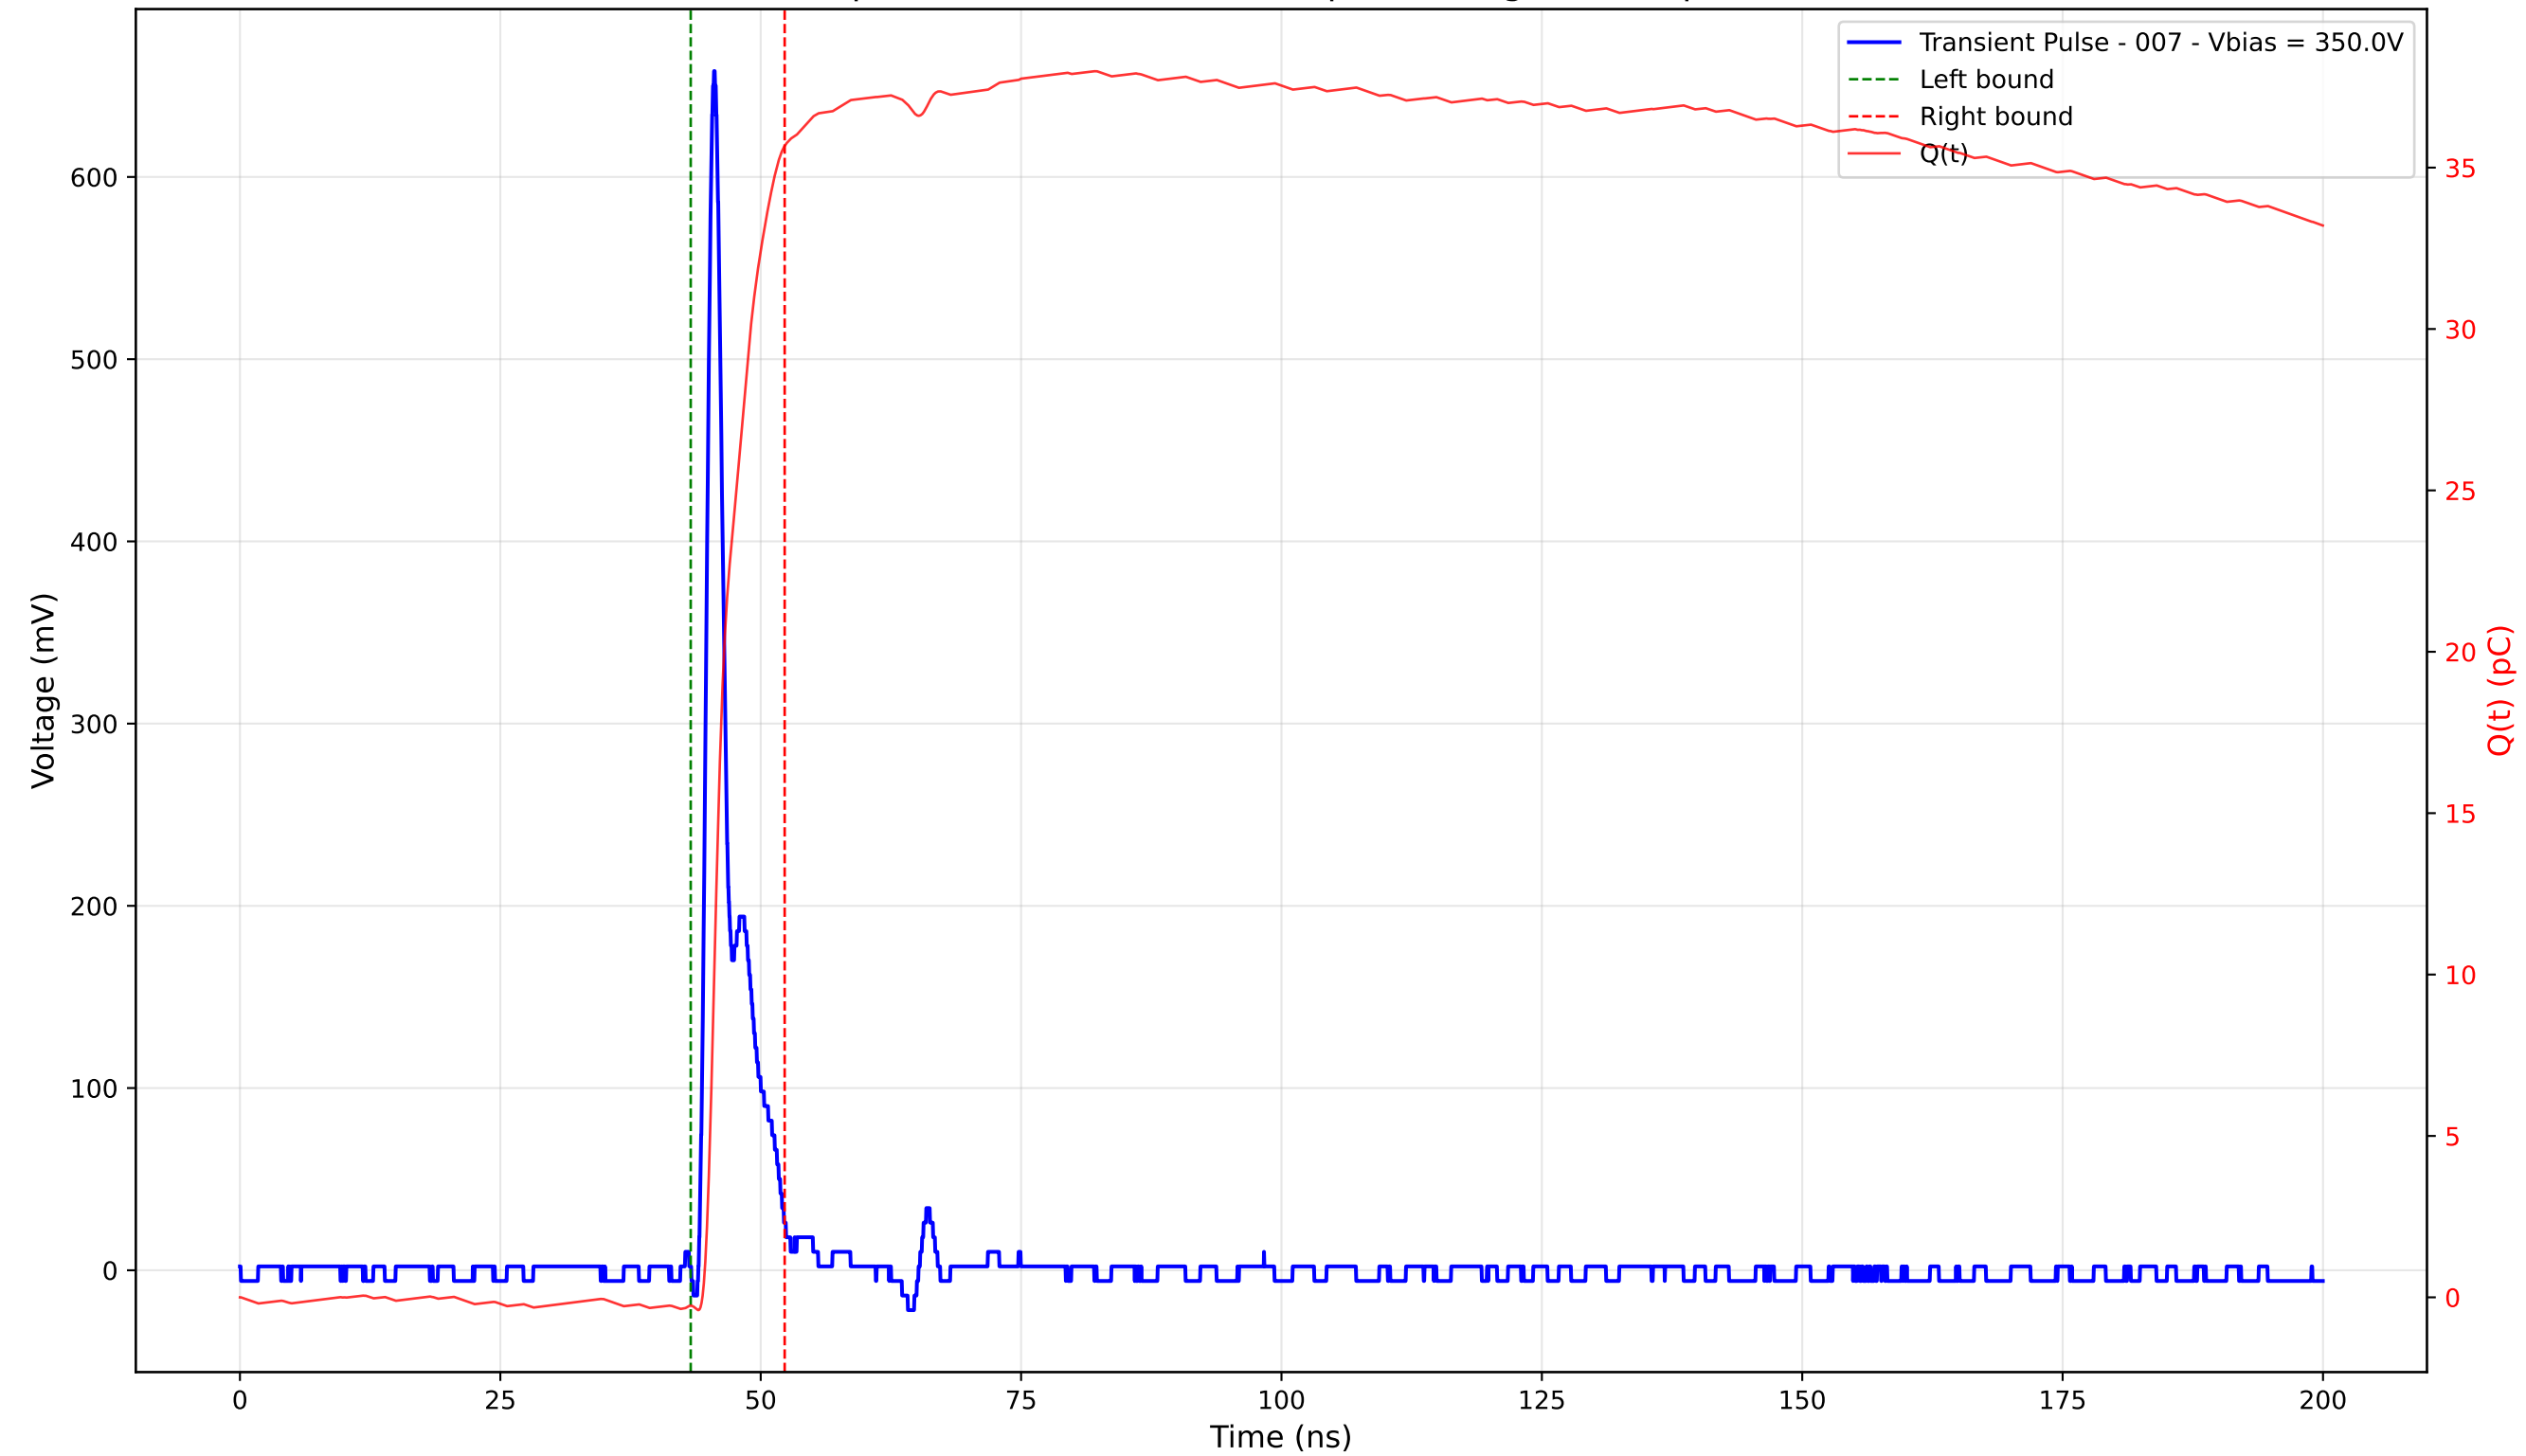


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 35.60 pC - Rise Time: 0.96 ns

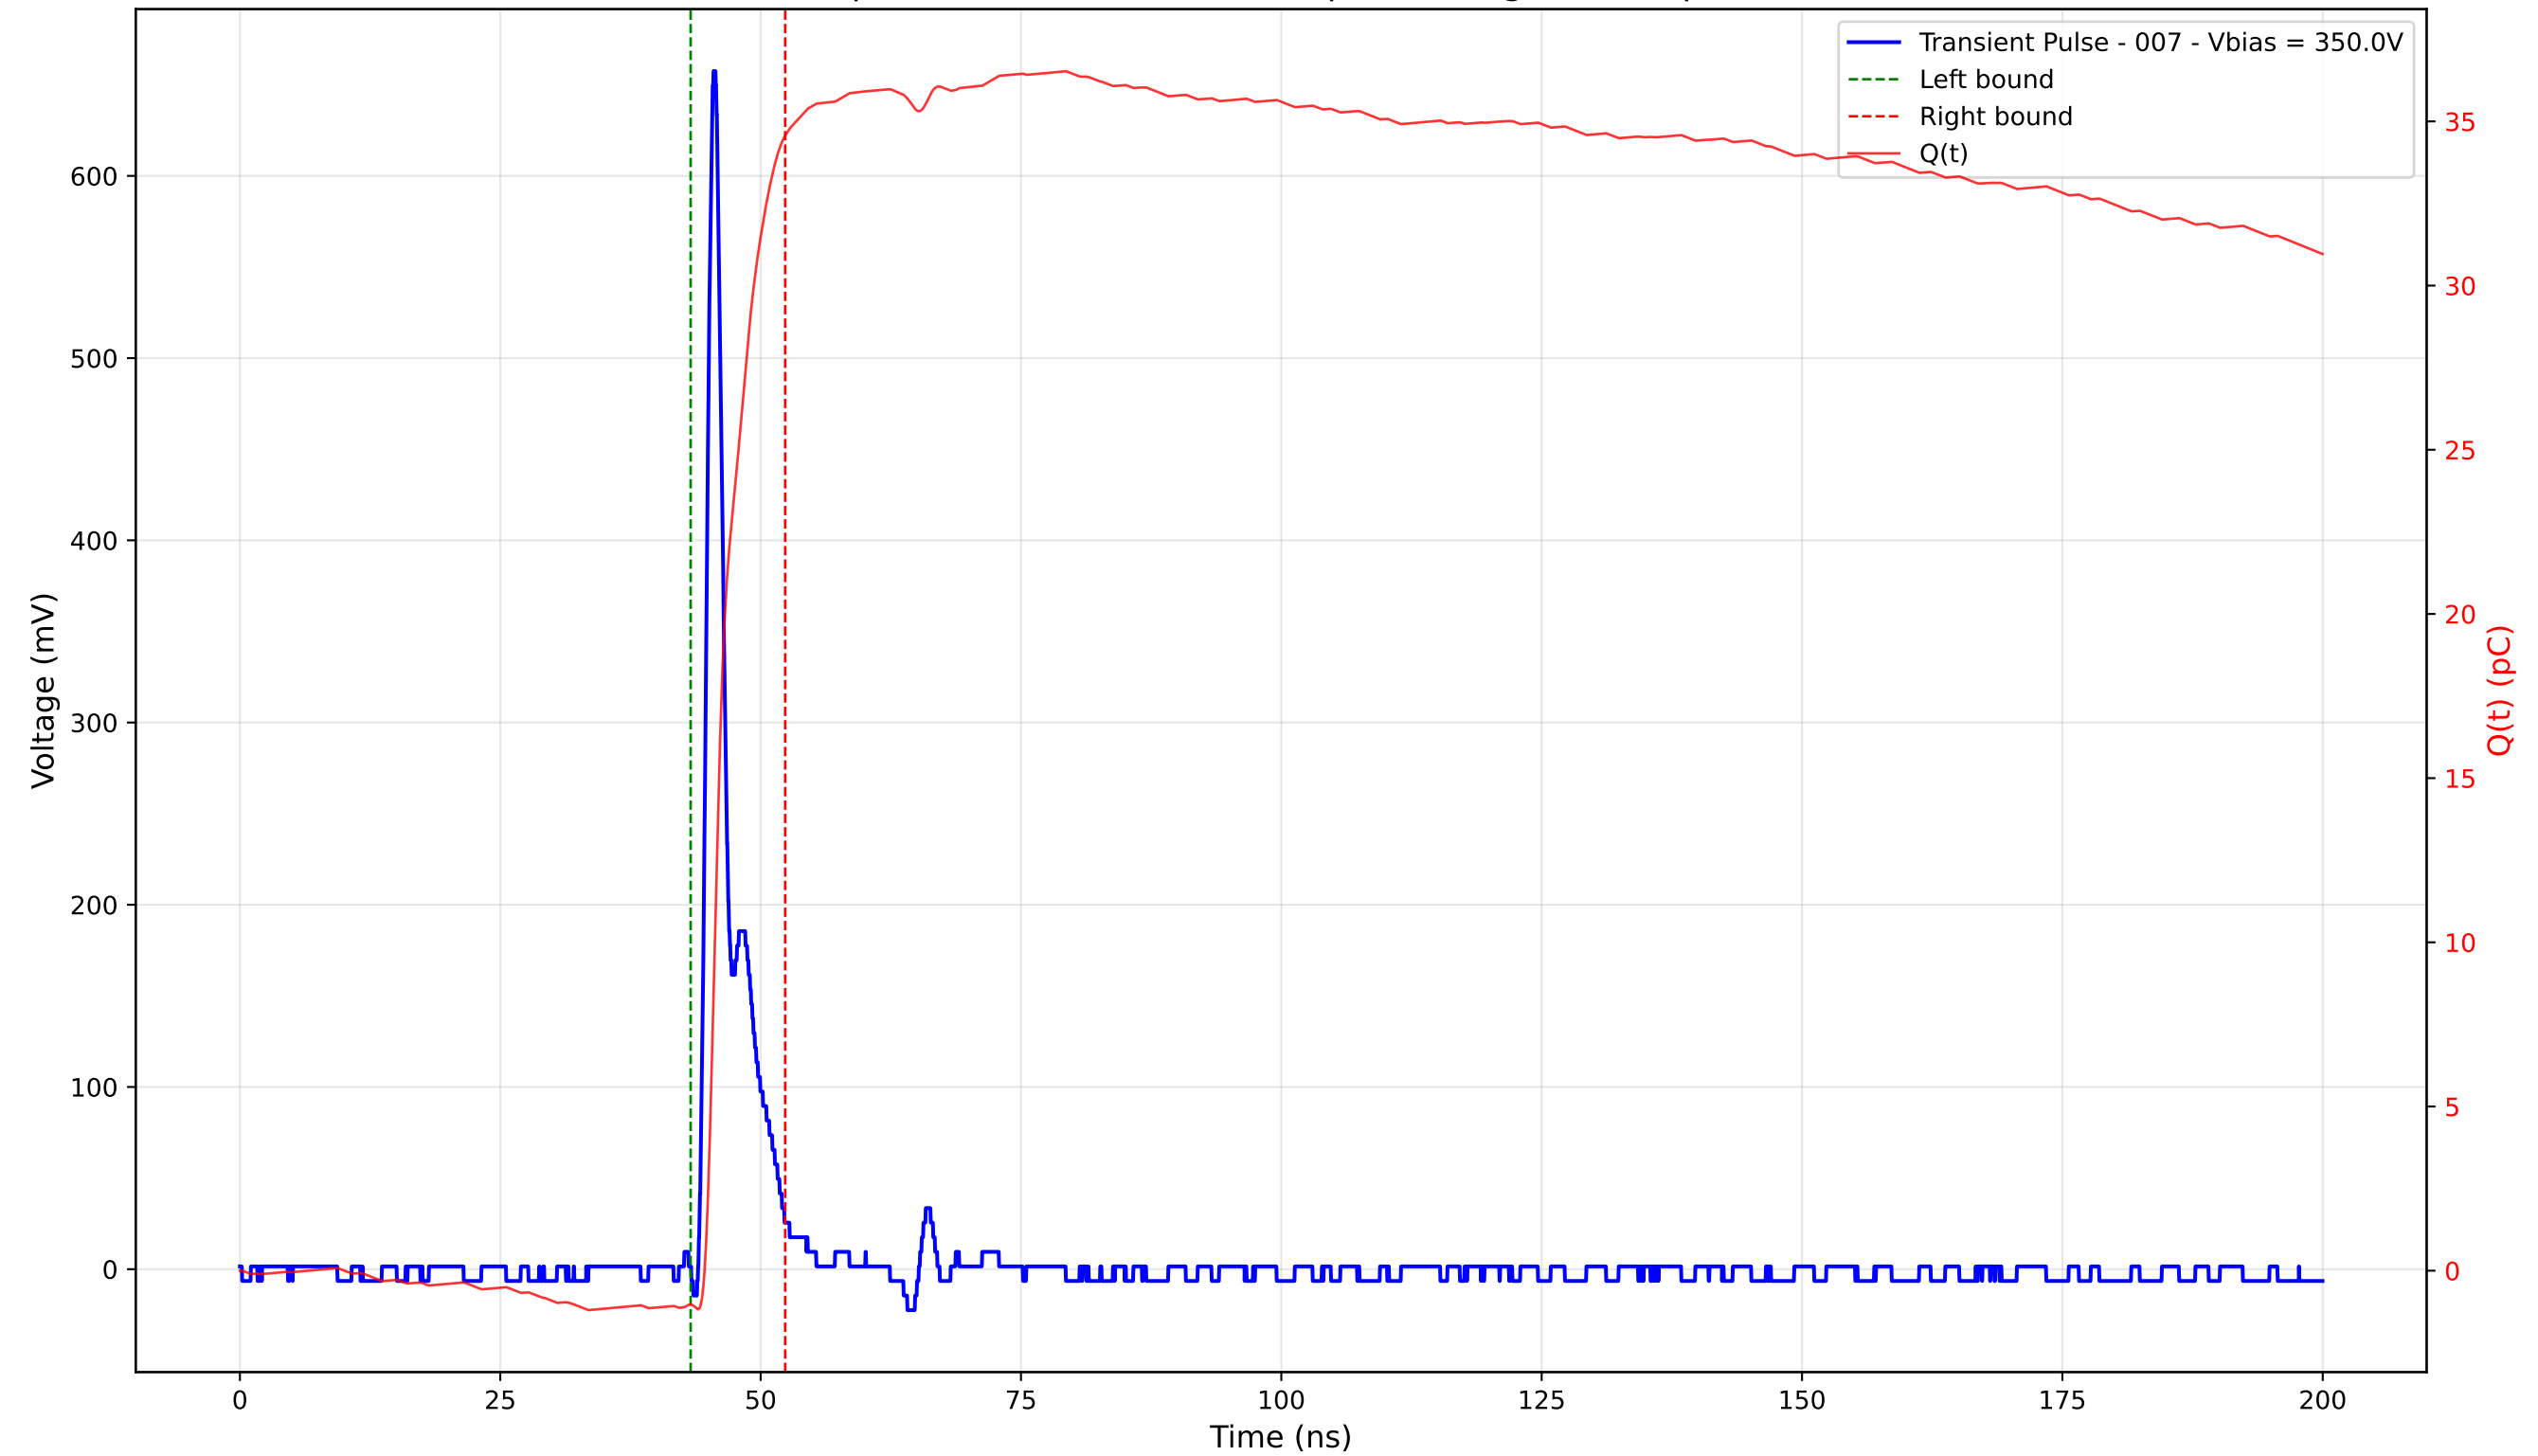


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 36.06 pC - Rise Time: 0.95 ns

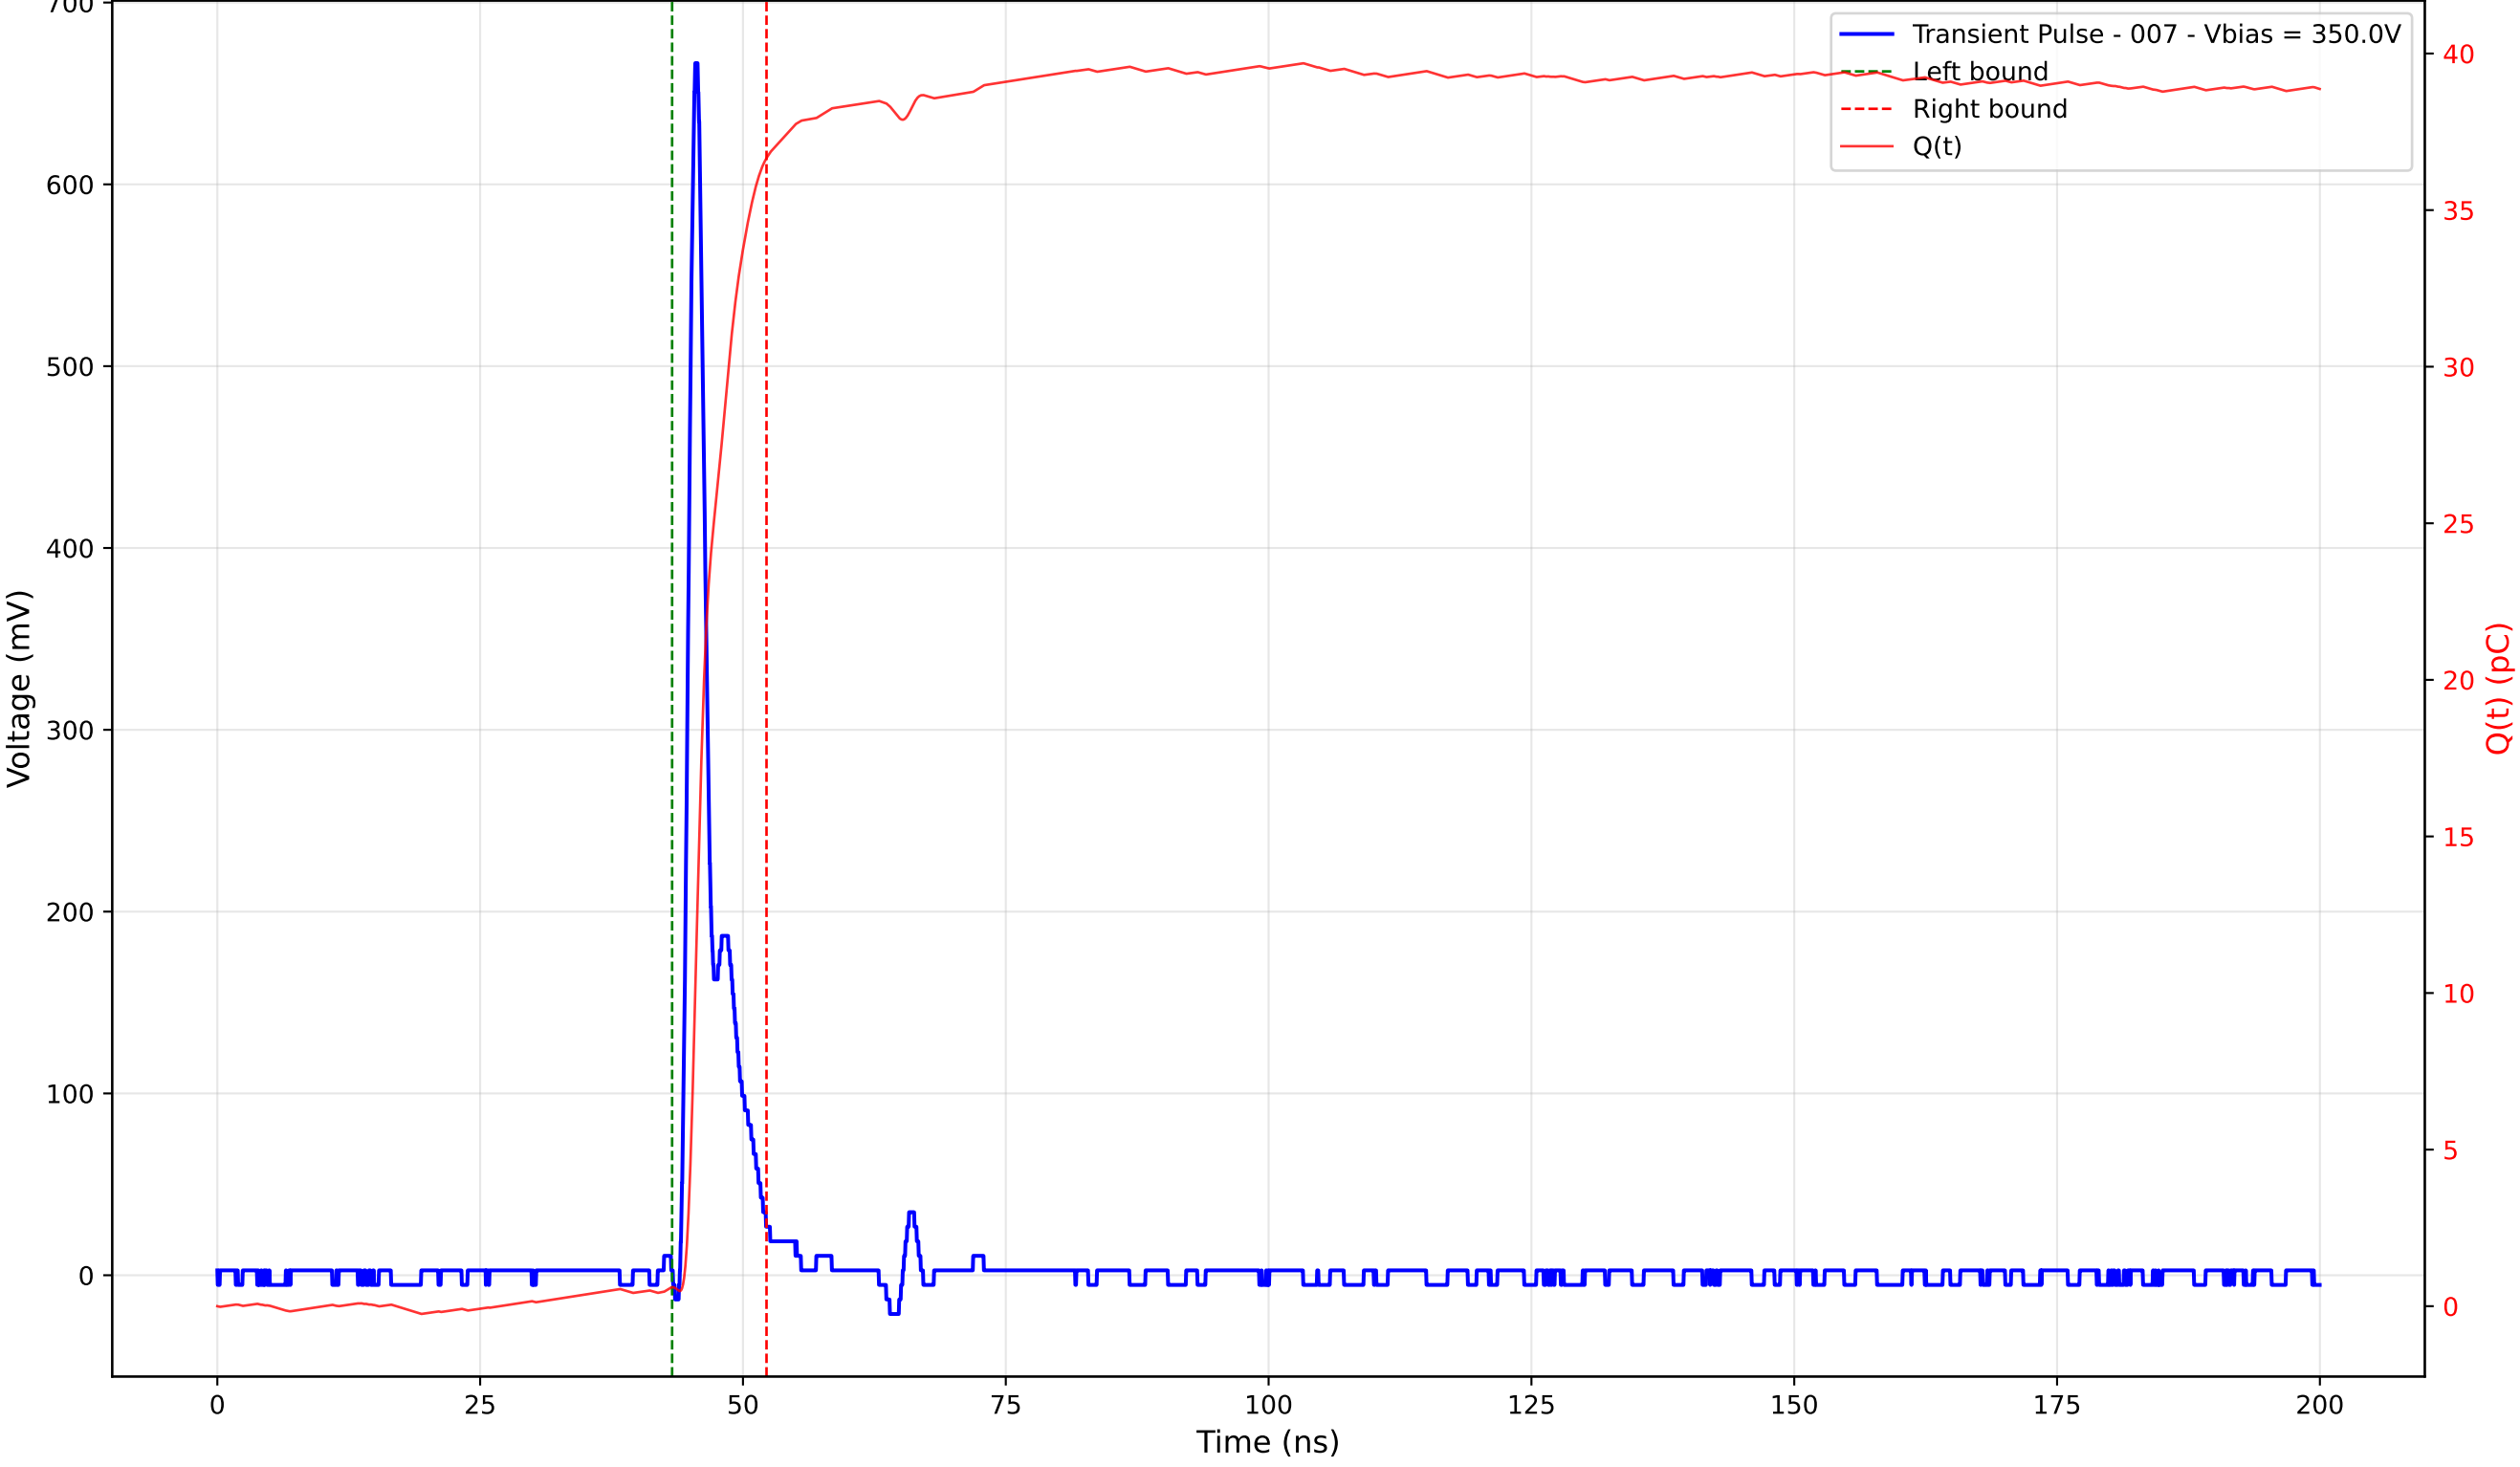


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 36.02 pC - Rise Time: 0.97 ns

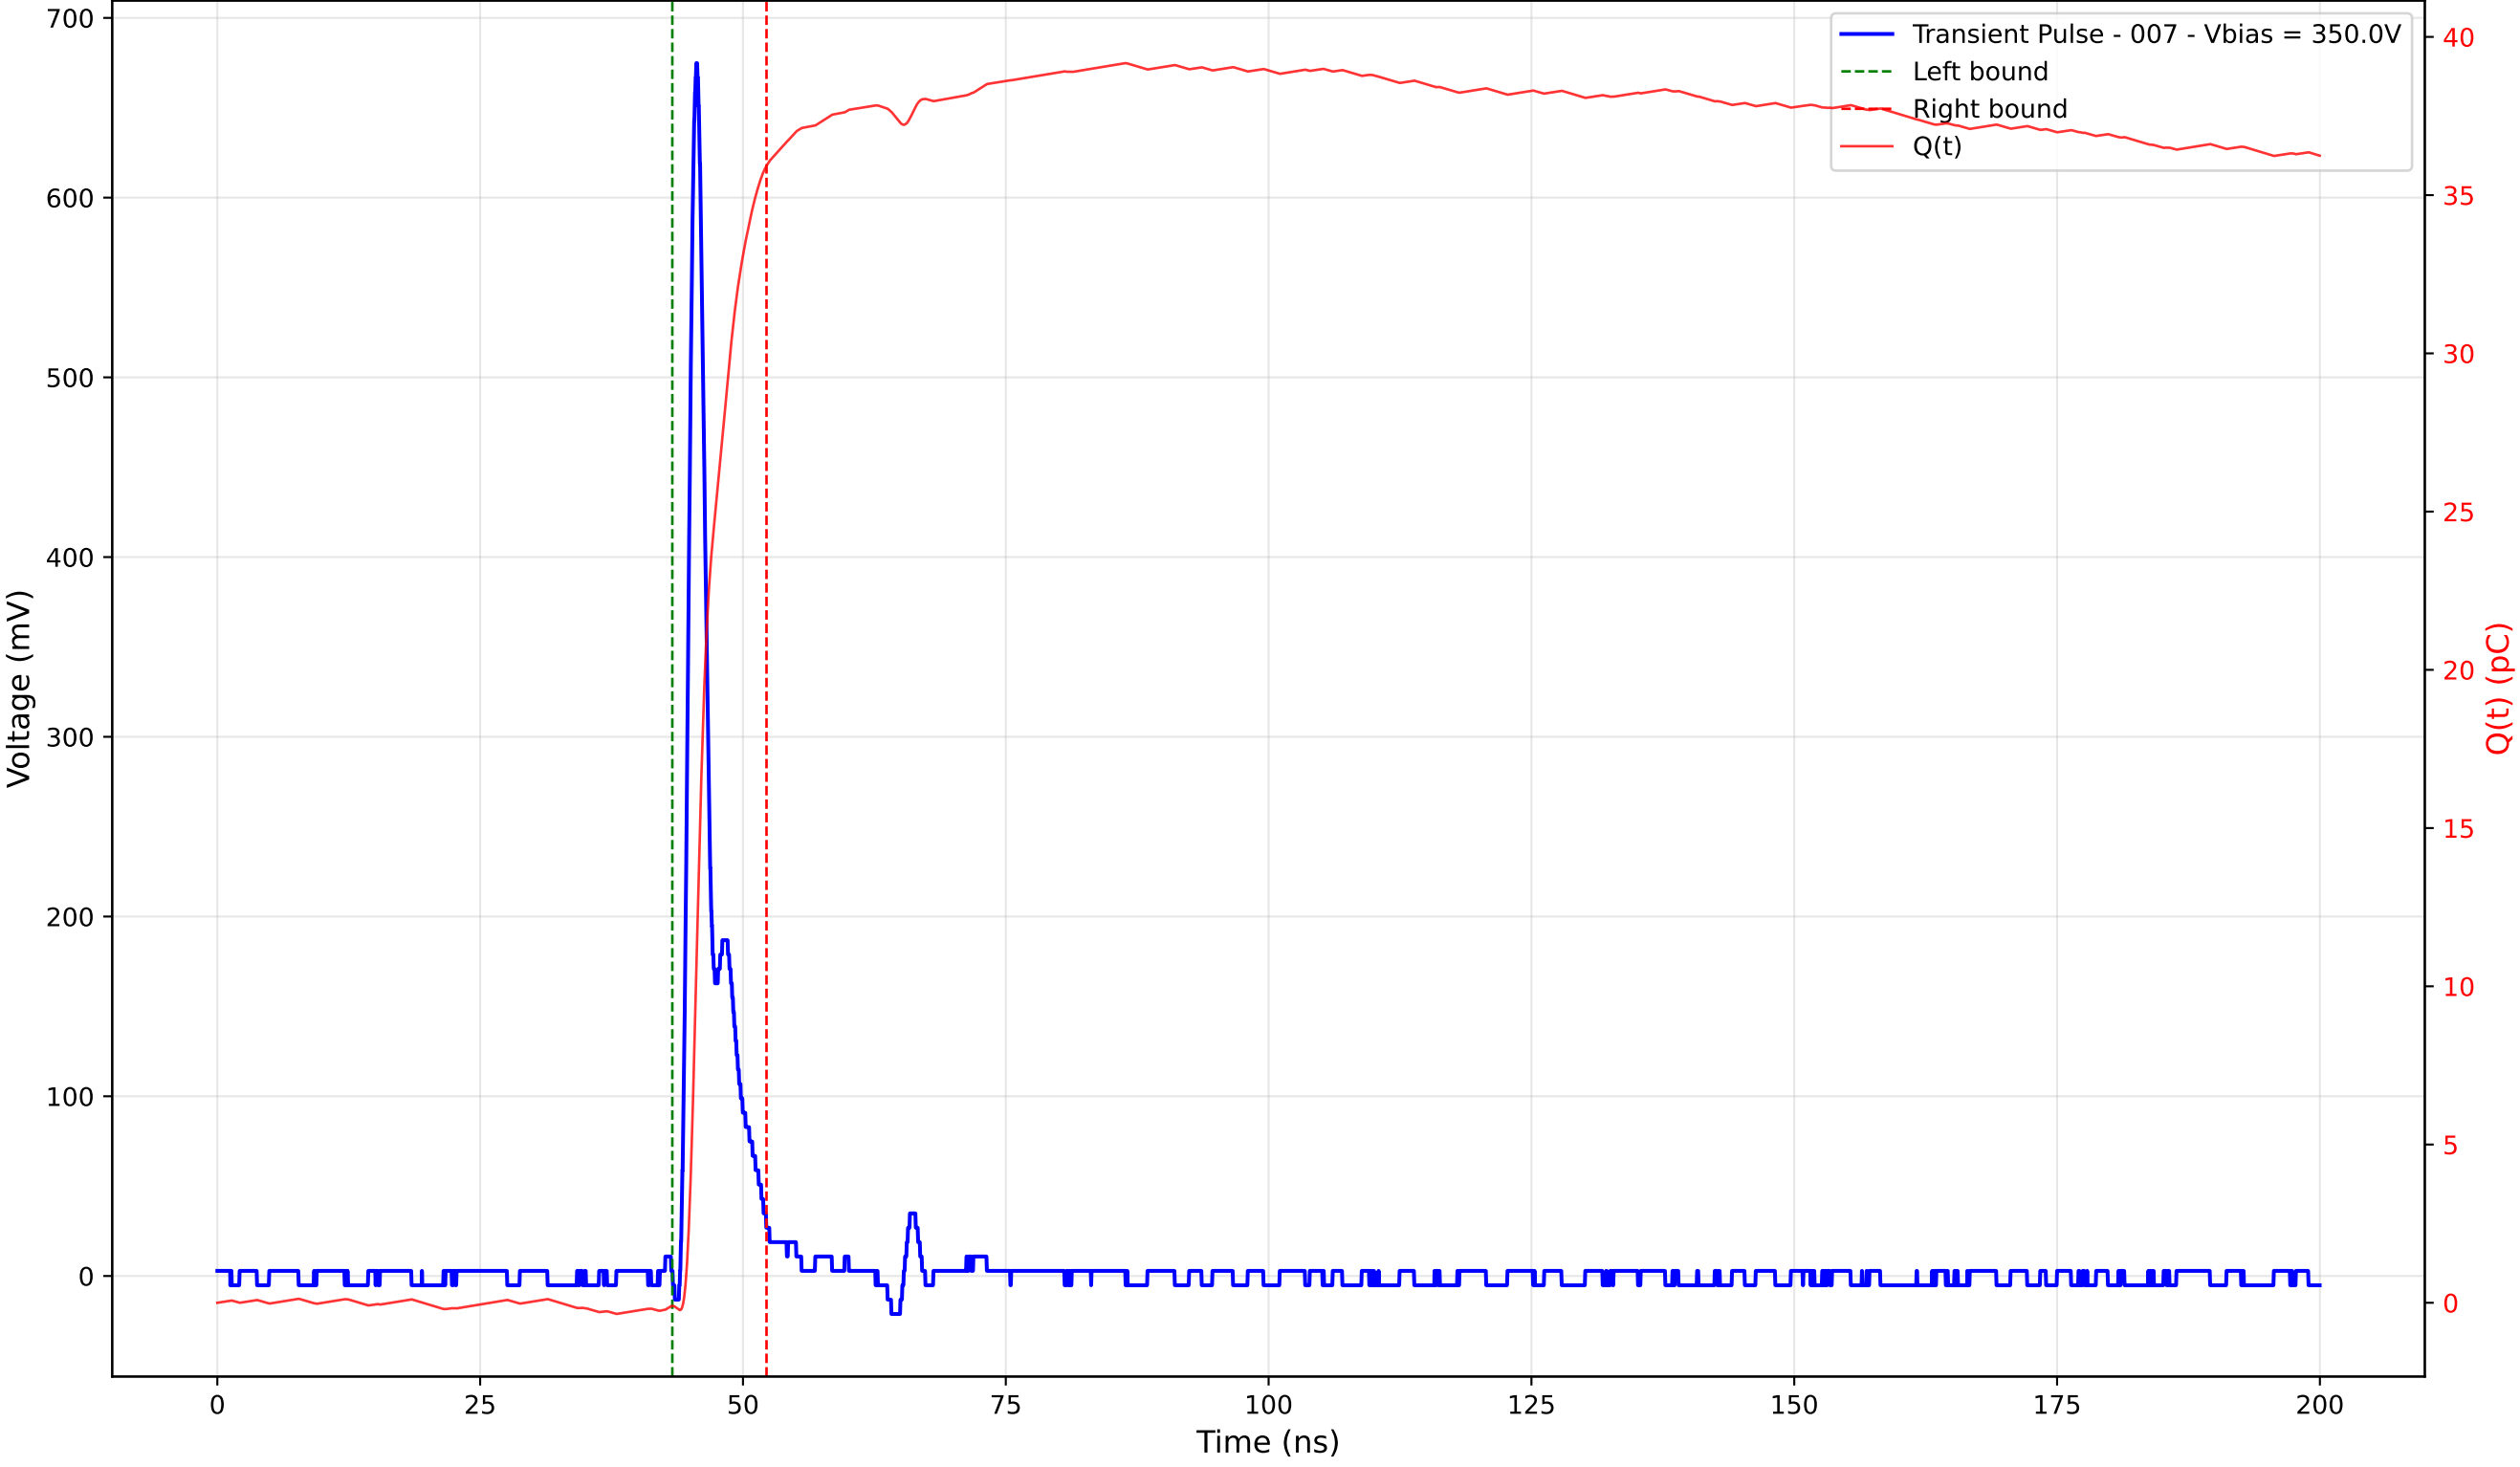


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 35.97 pC - Rise Time: 1.01 ns

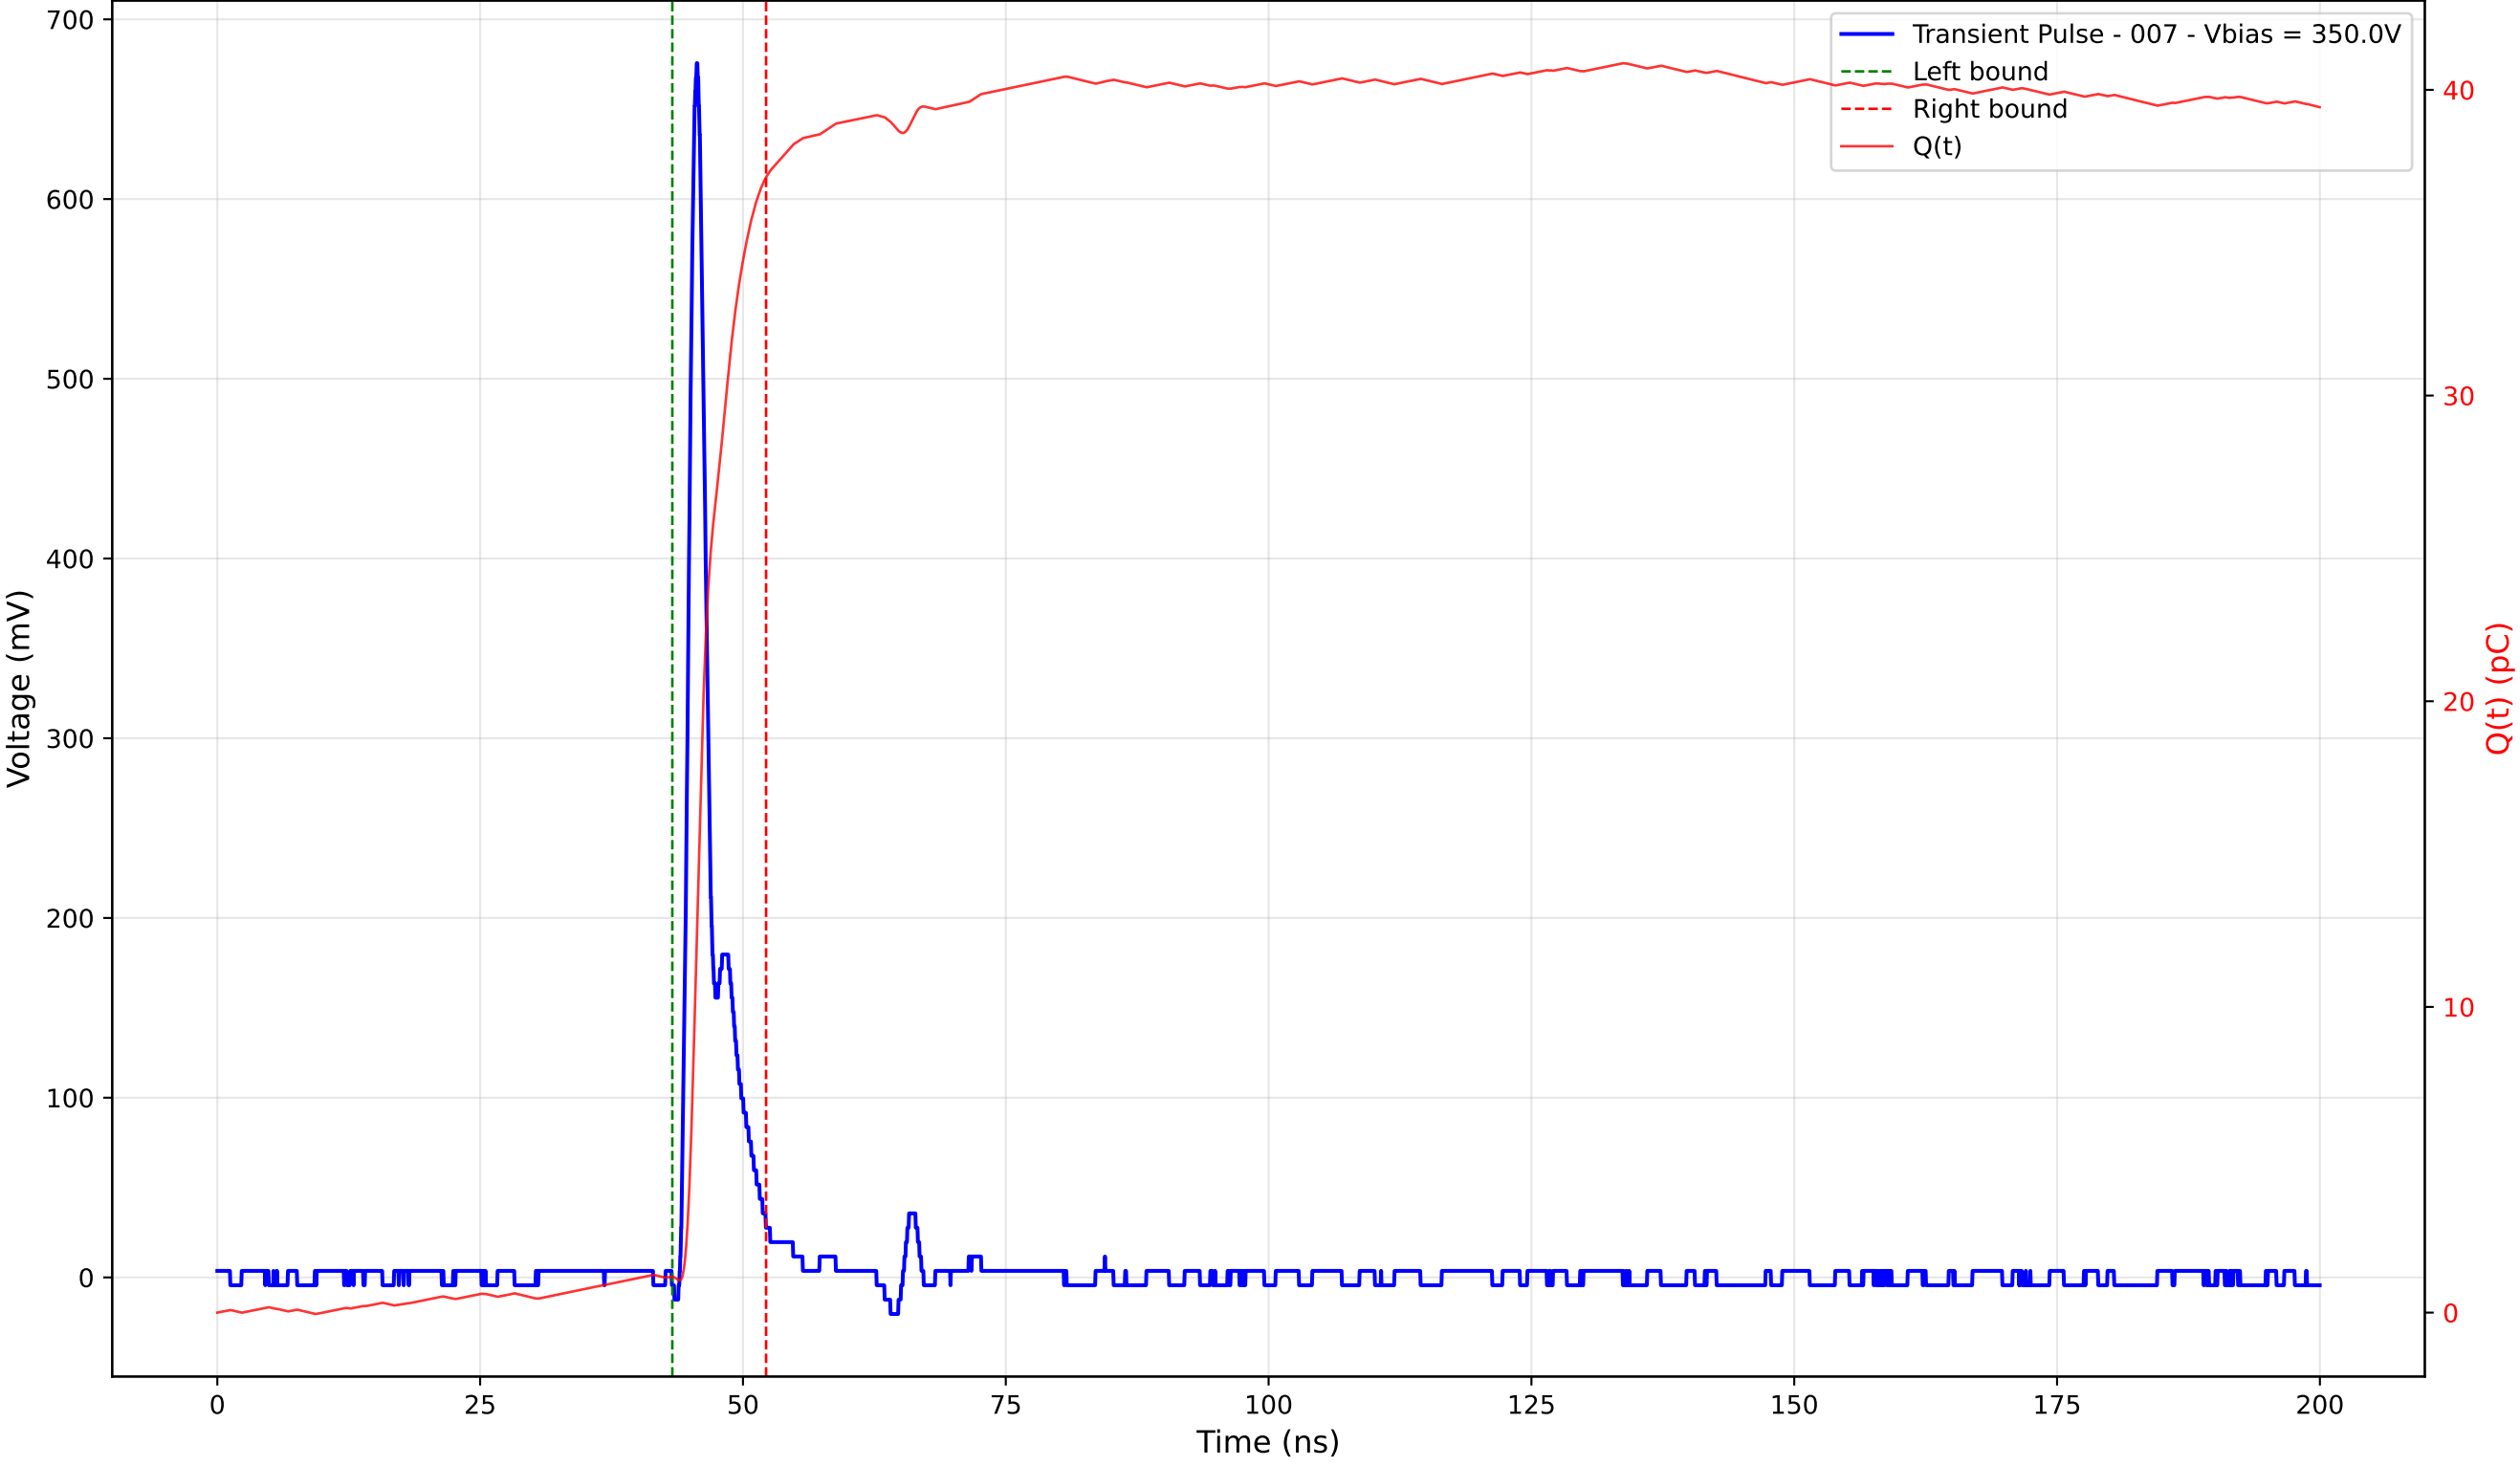


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 36.02 pC - Rise Time: 1.01 ns

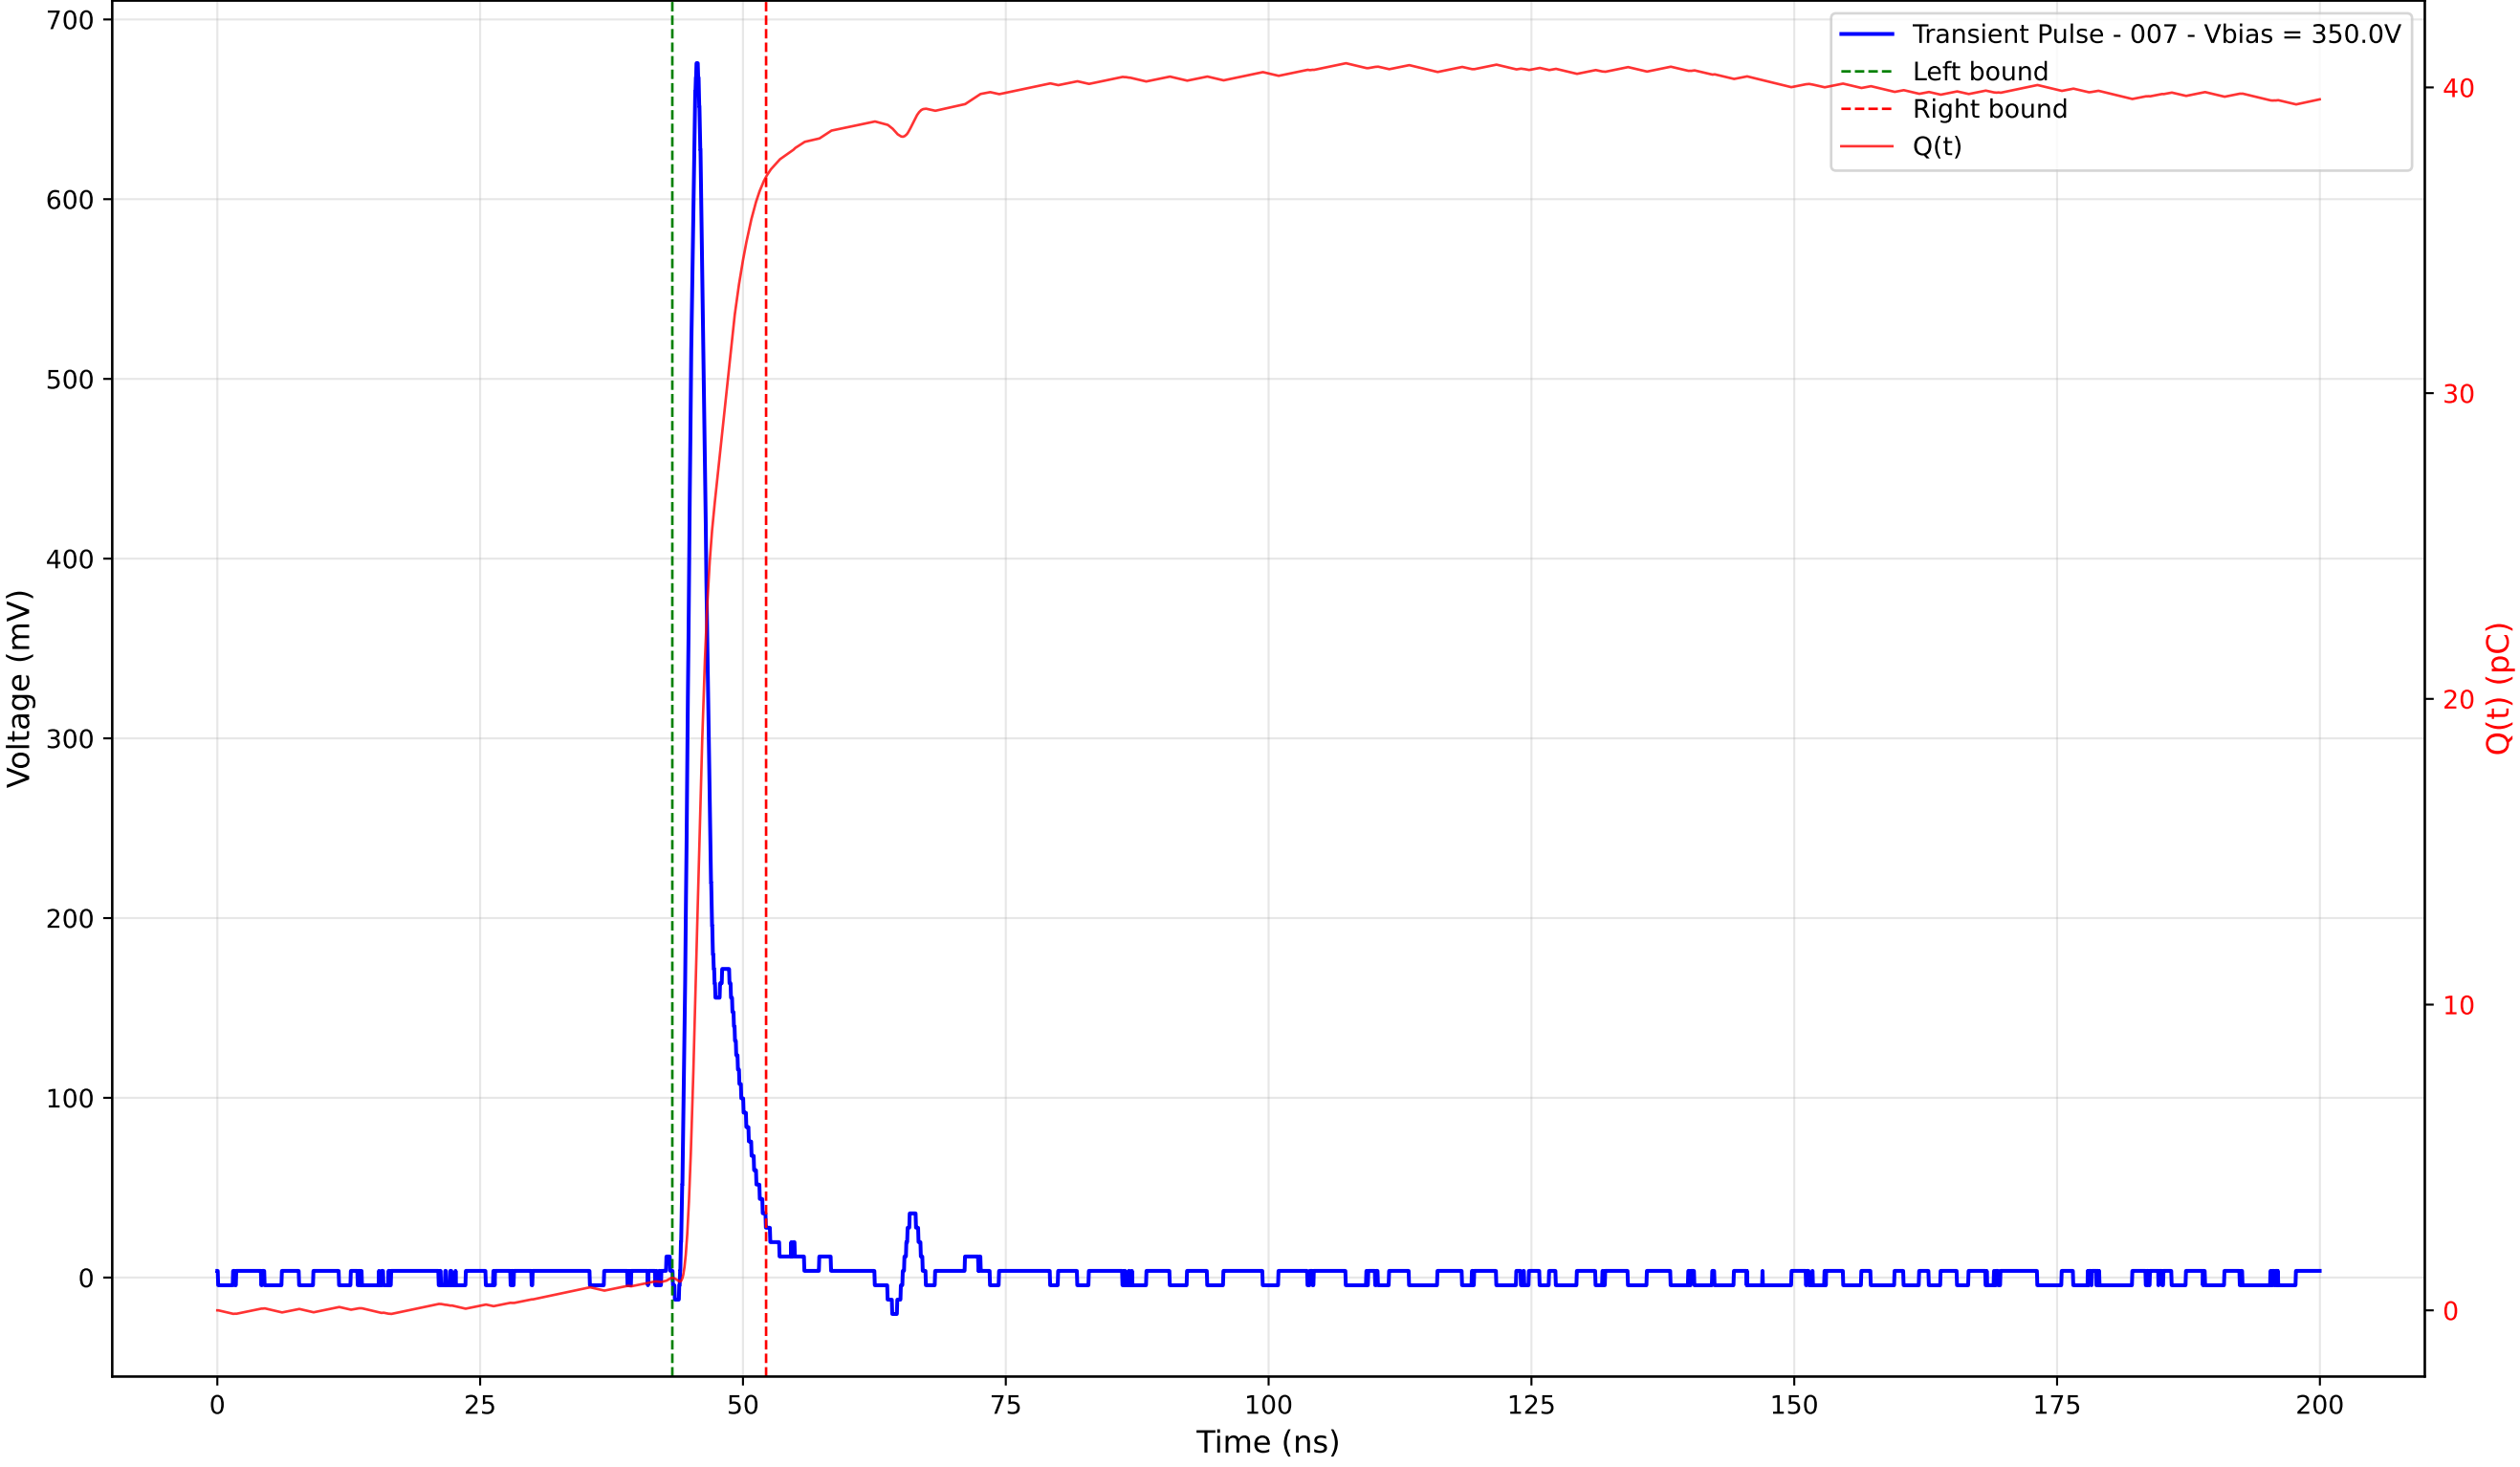


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 35.85 pC - Rise Time: 1.01 ns

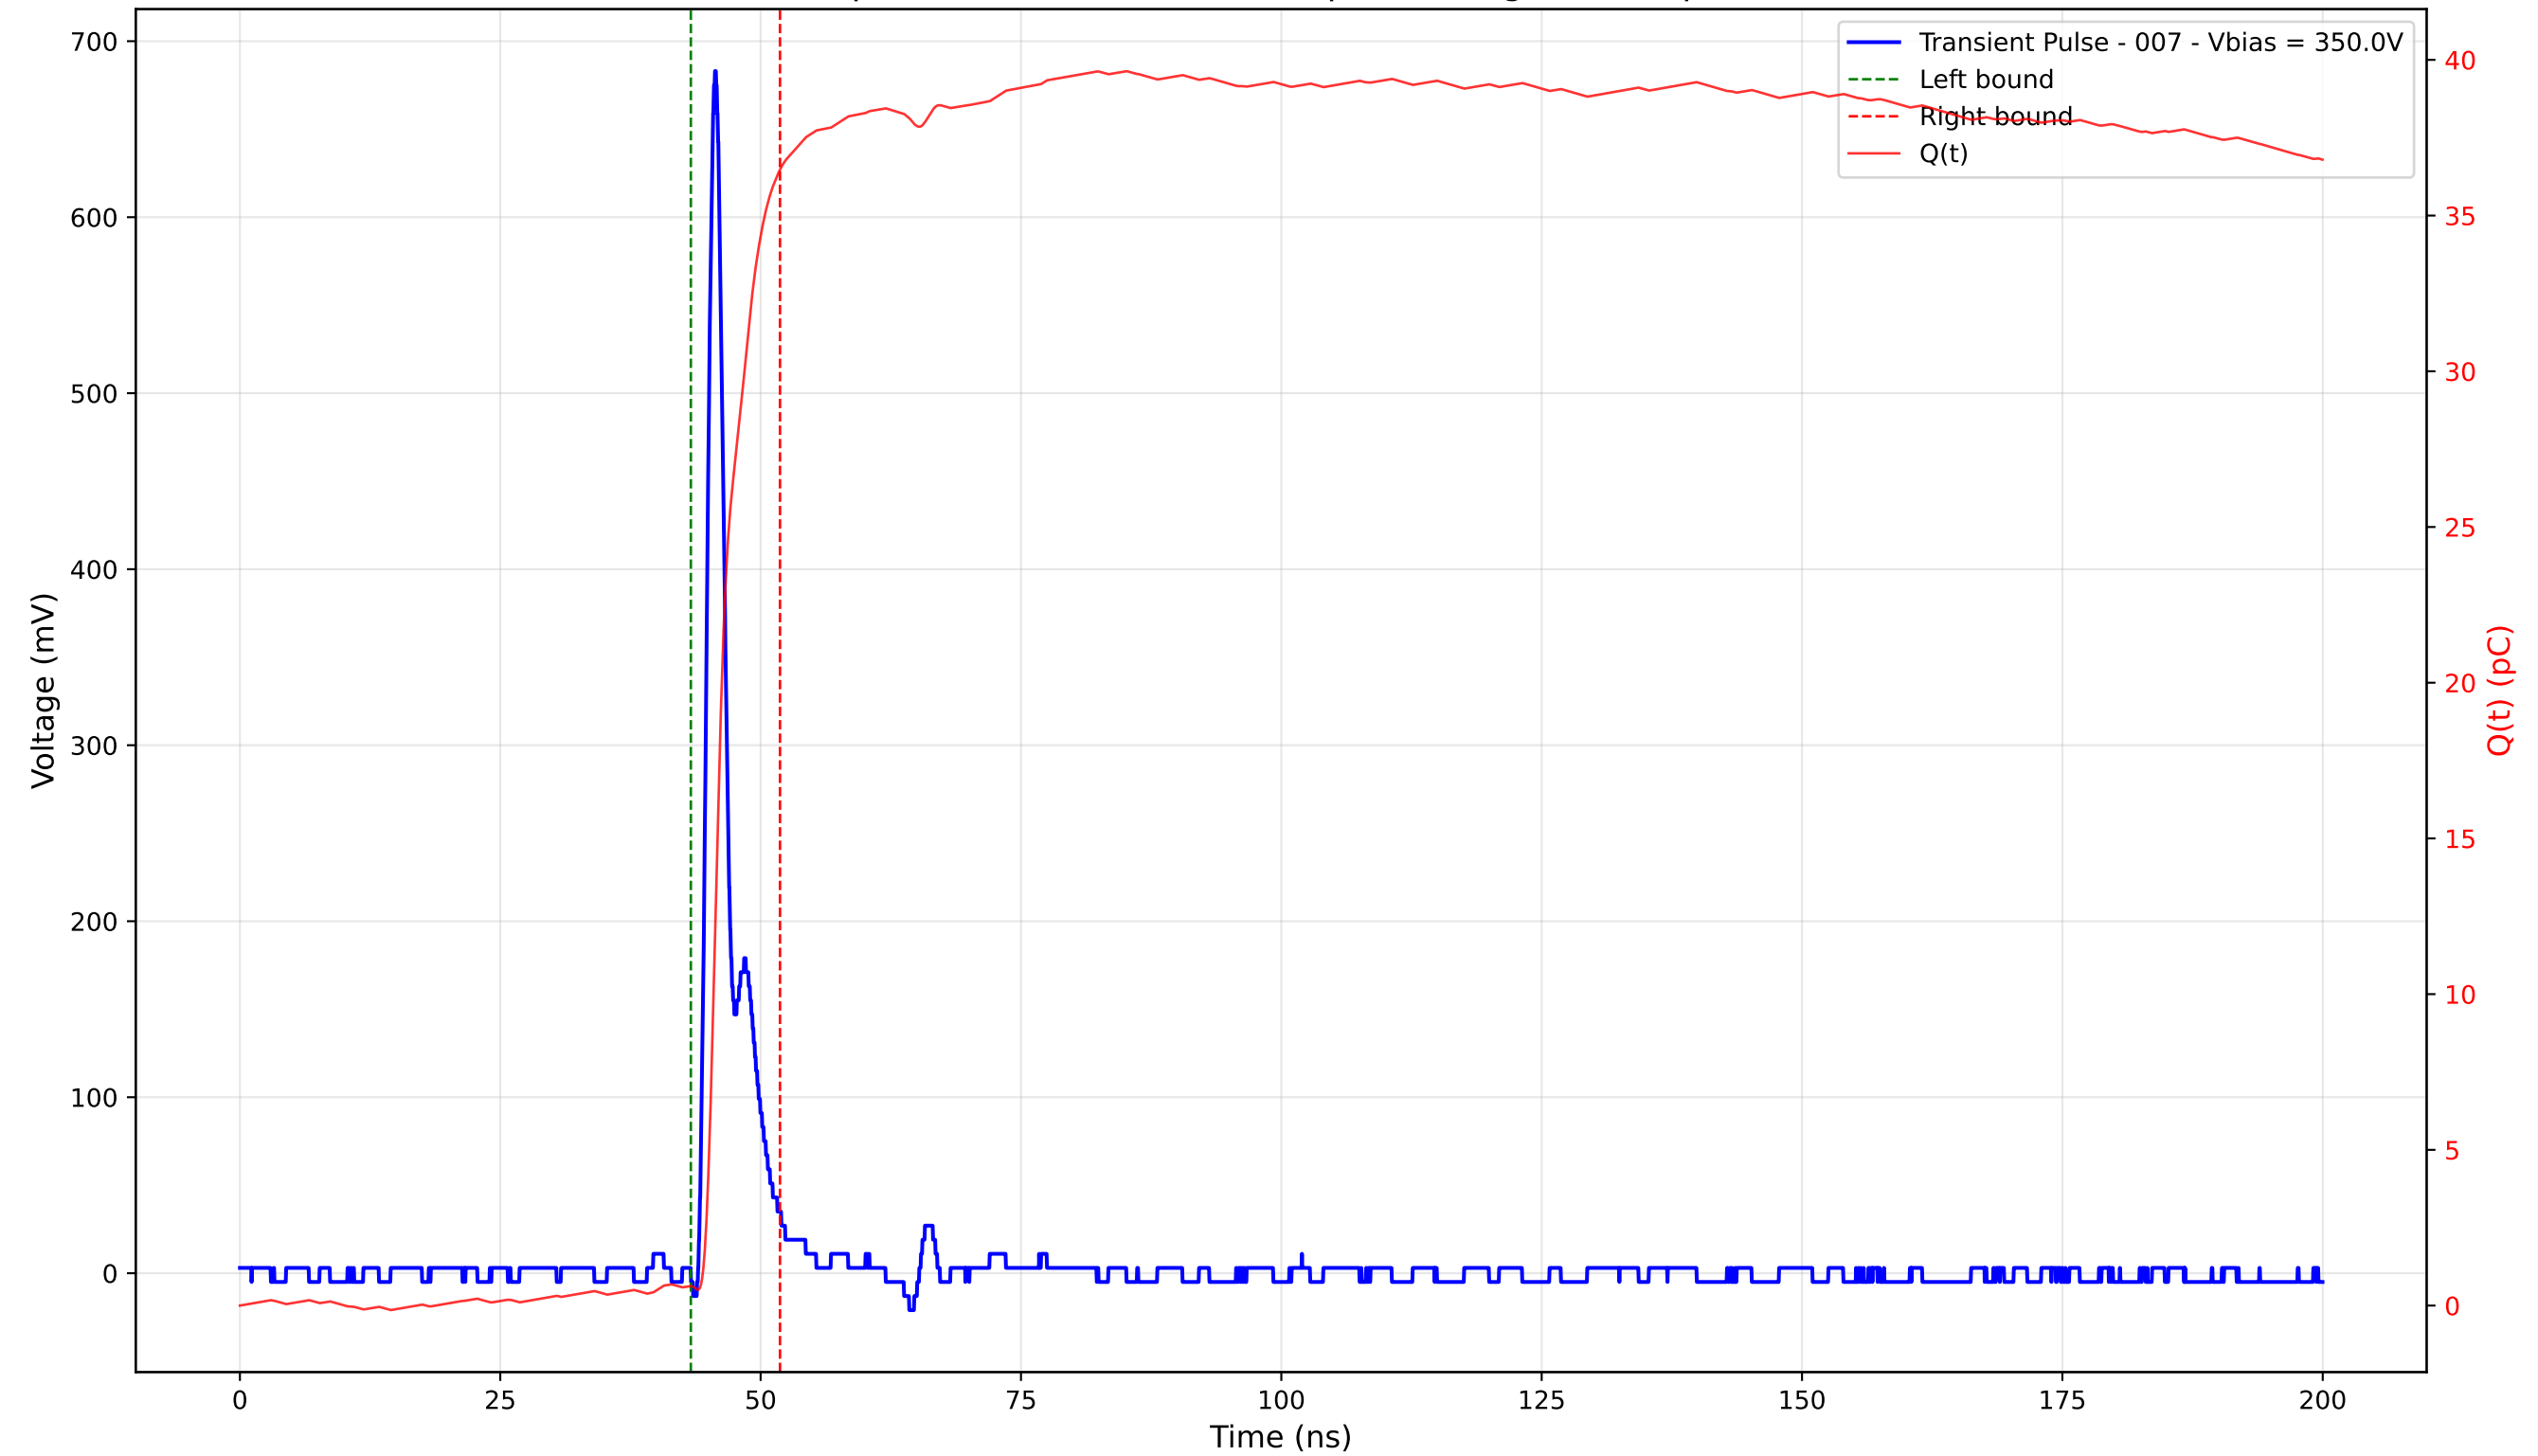


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 35.85 pC - Rise Time: 1.03 ns

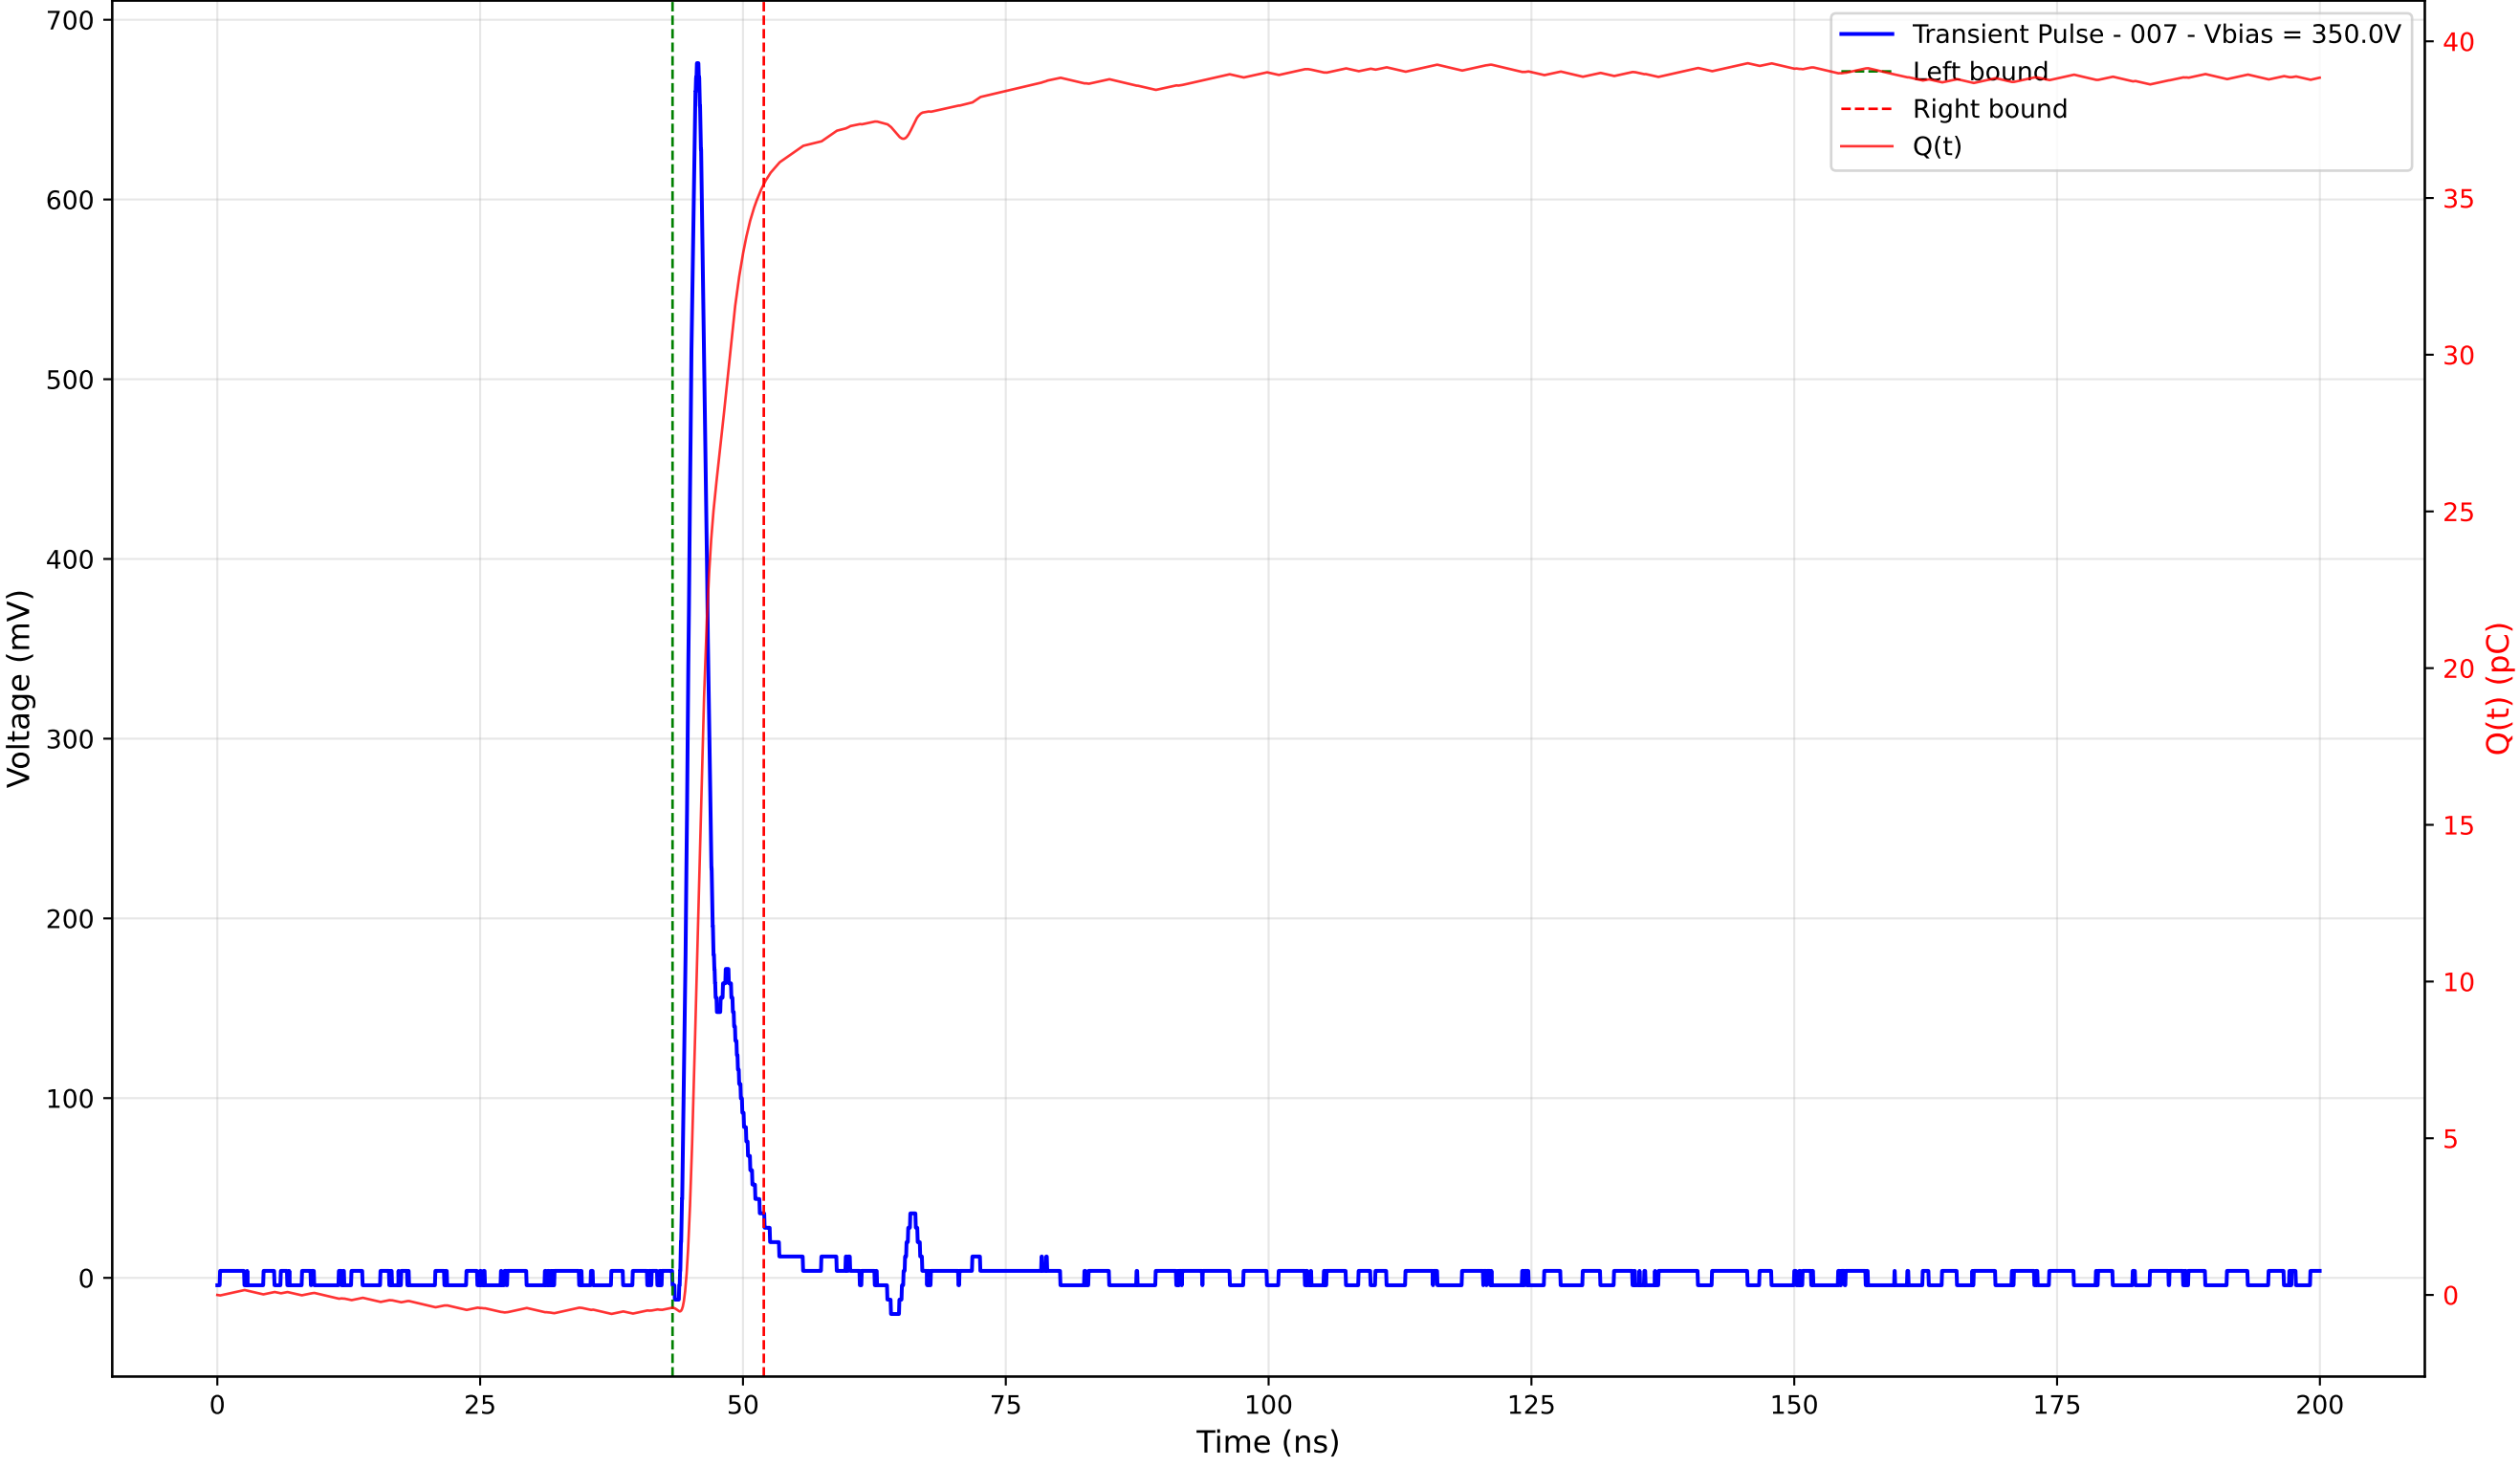


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 34.93 pC - Rise Time: 1.02 ns

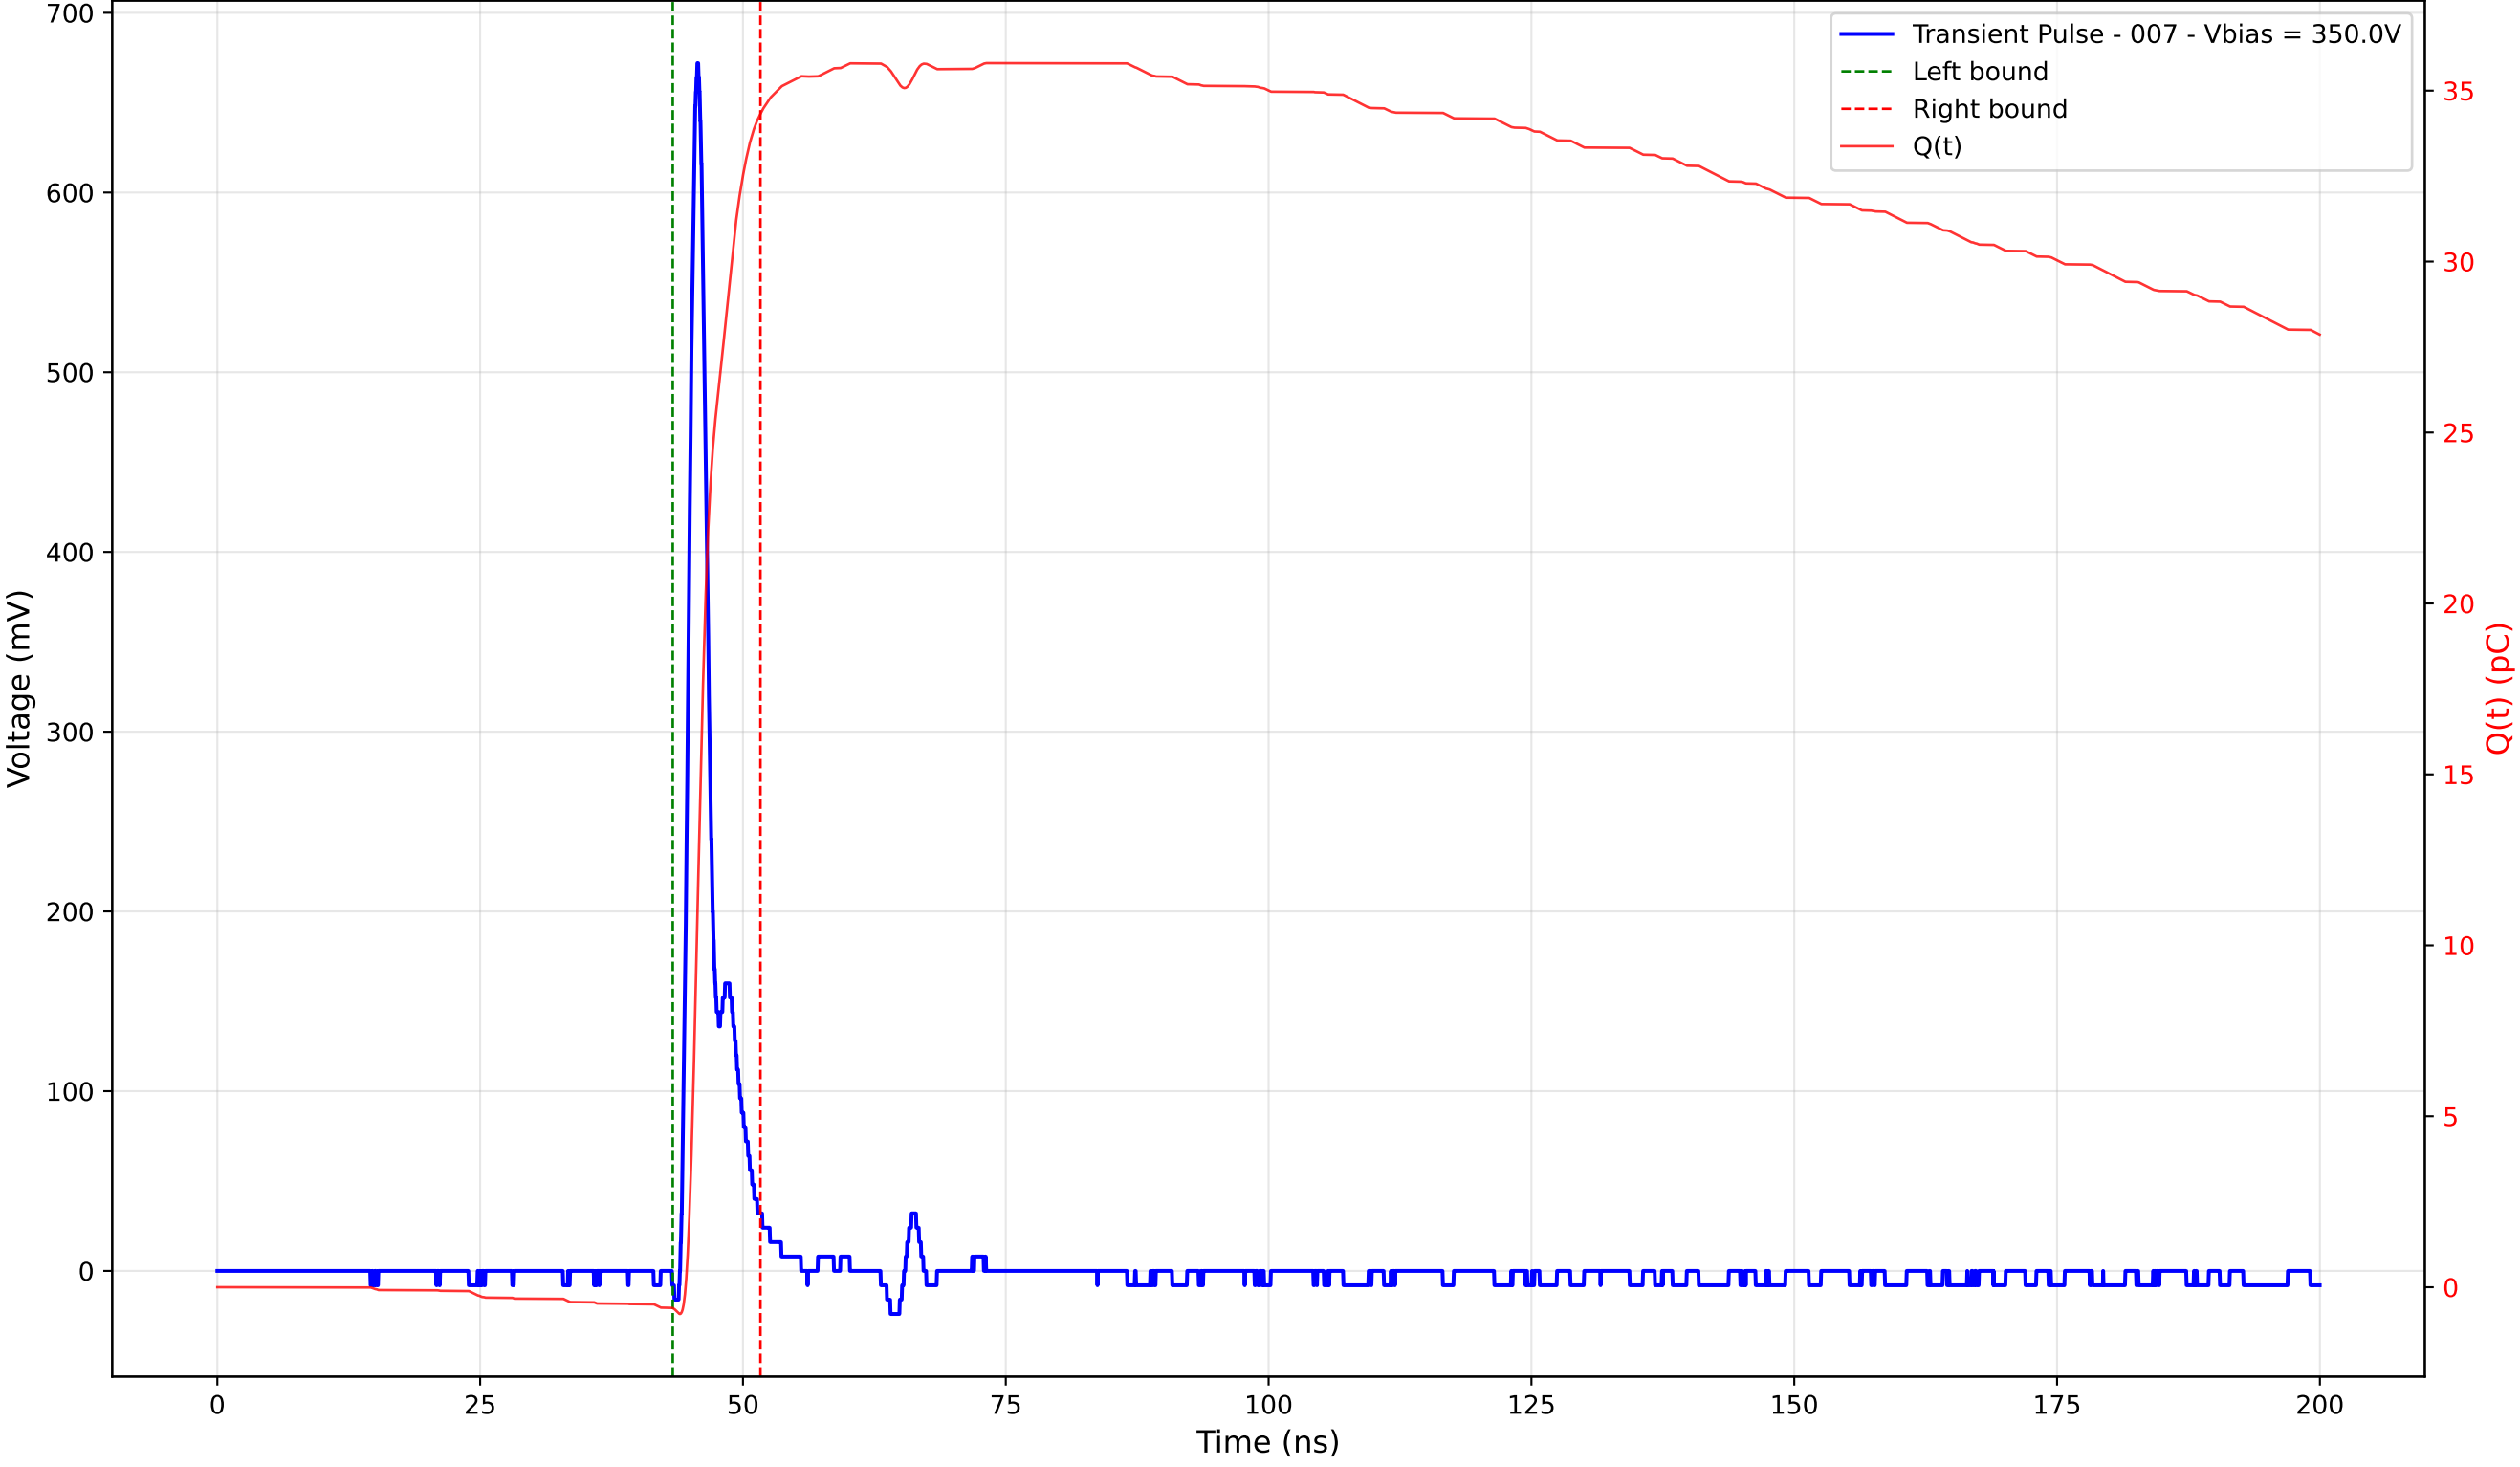


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 34.80 pC - Rise Time: 1.06 ns

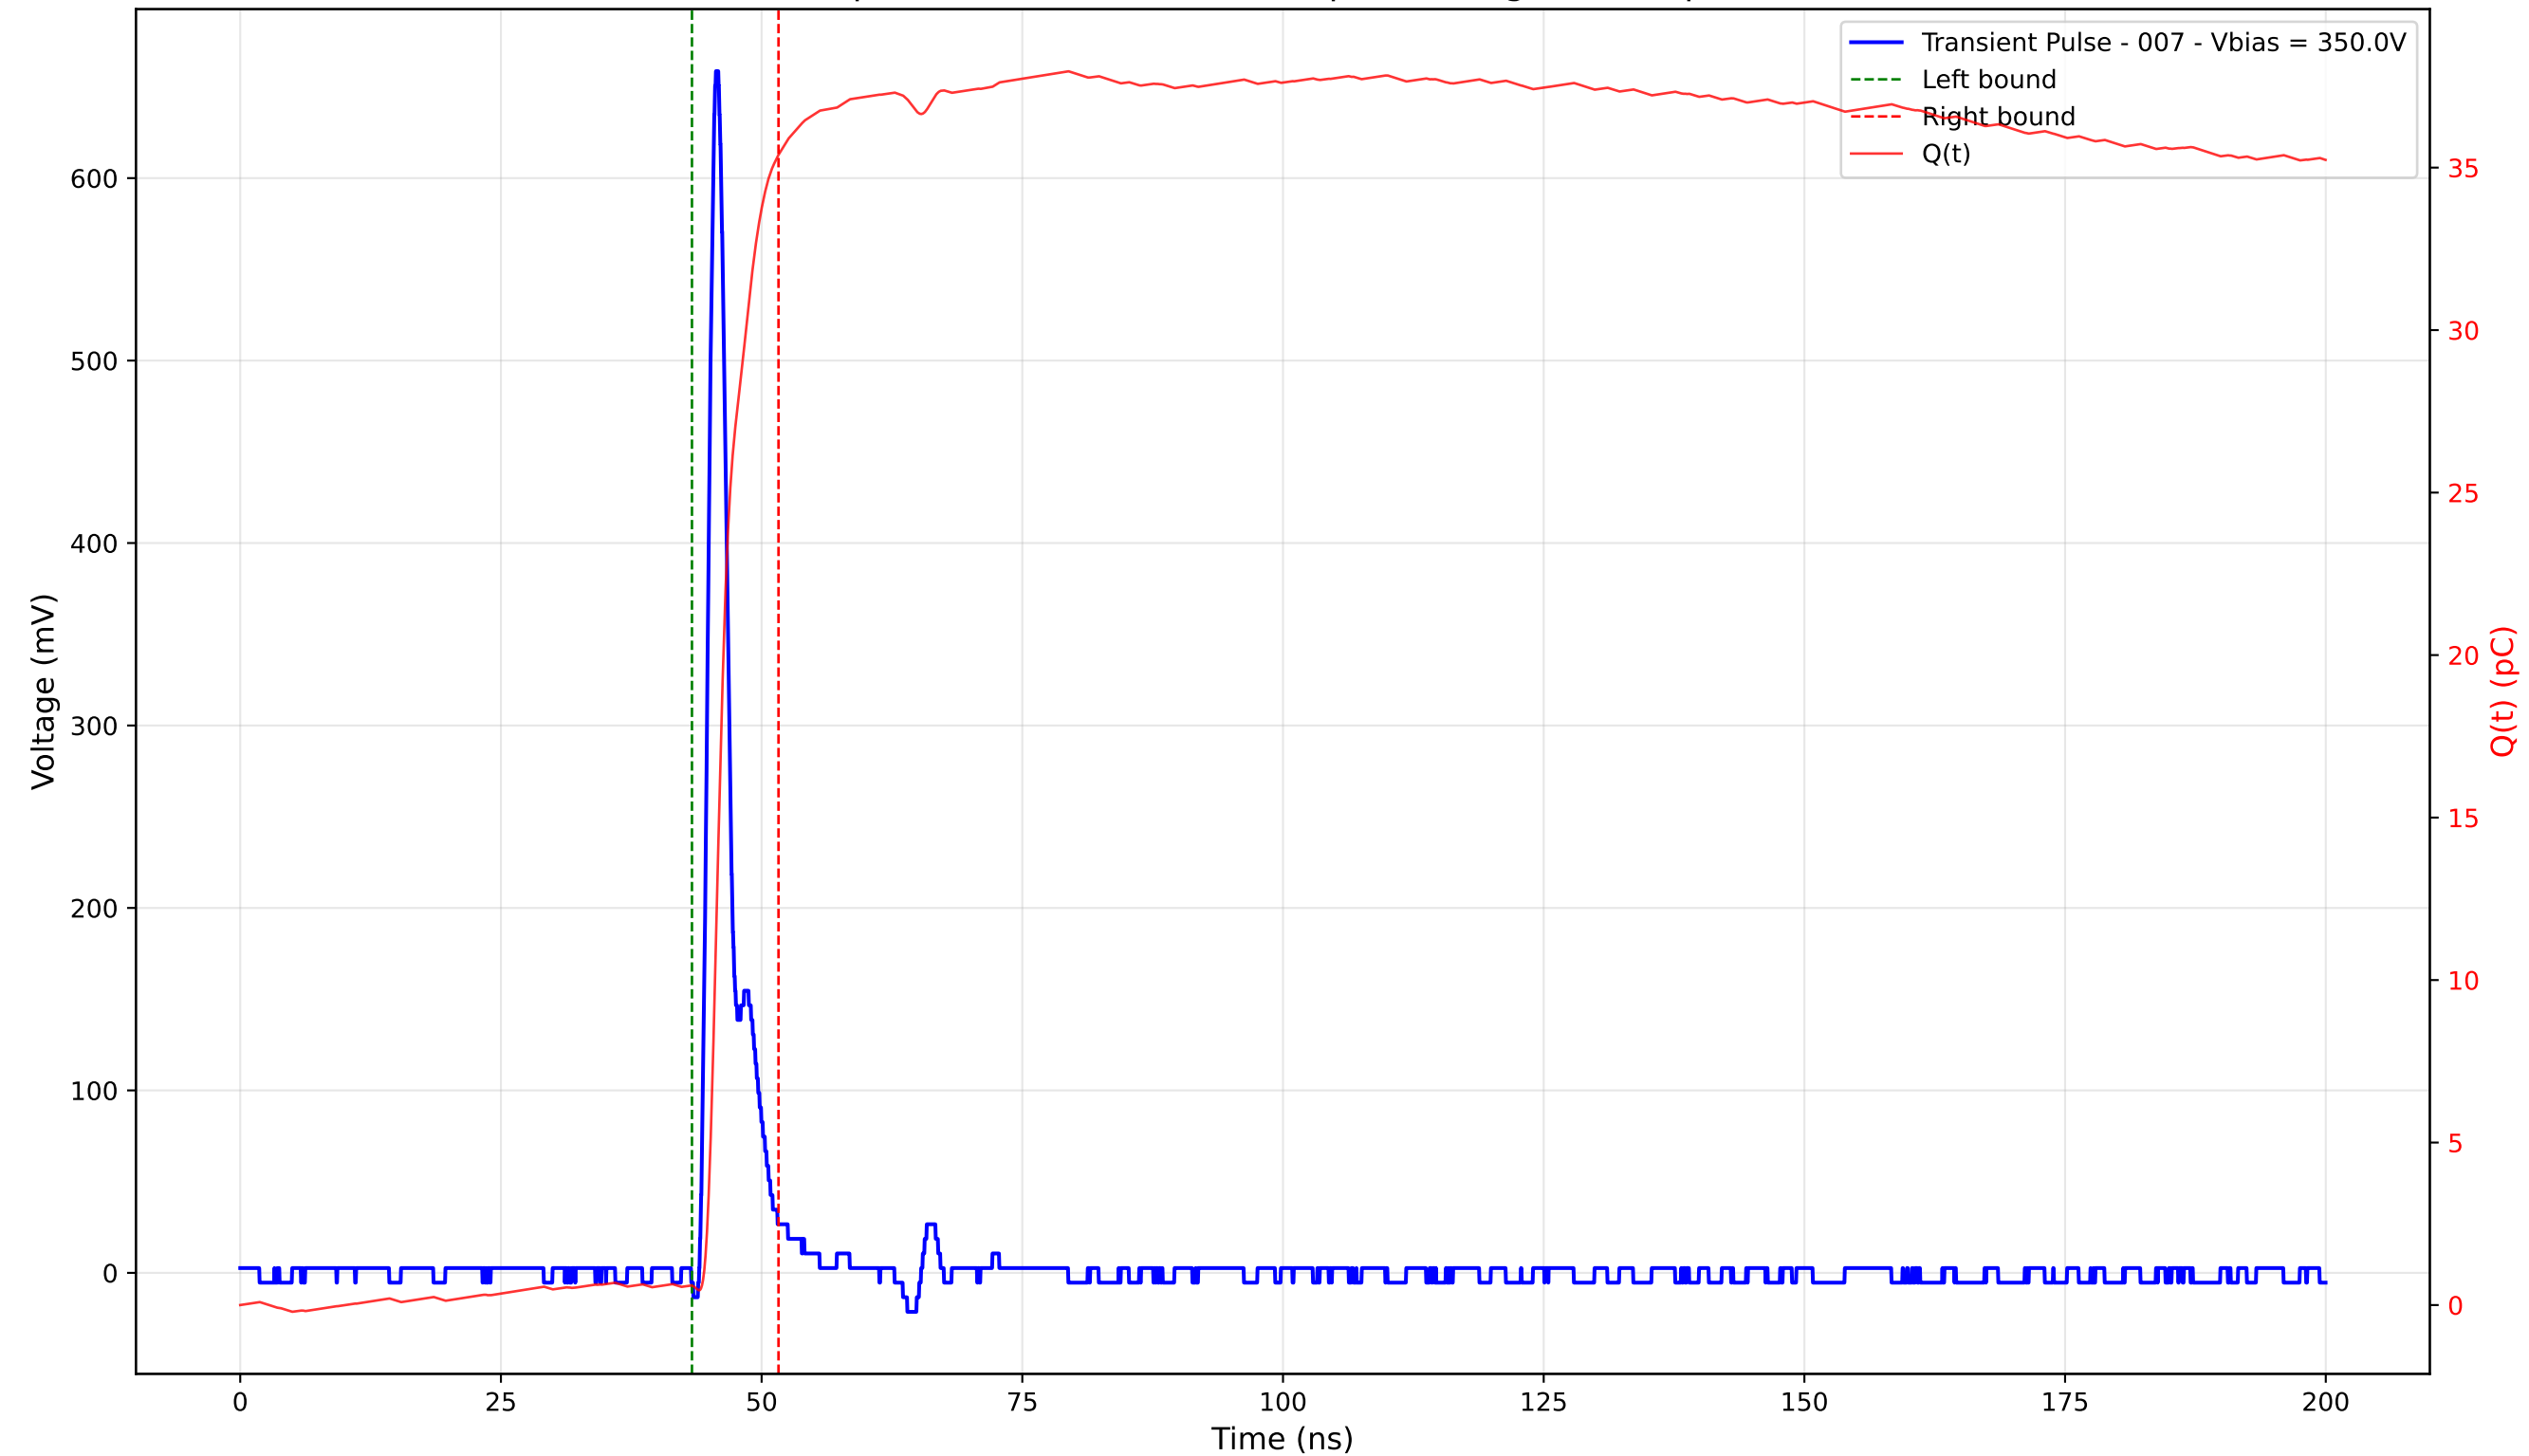


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 34.99 pC - Rise Time: 1.04 ns

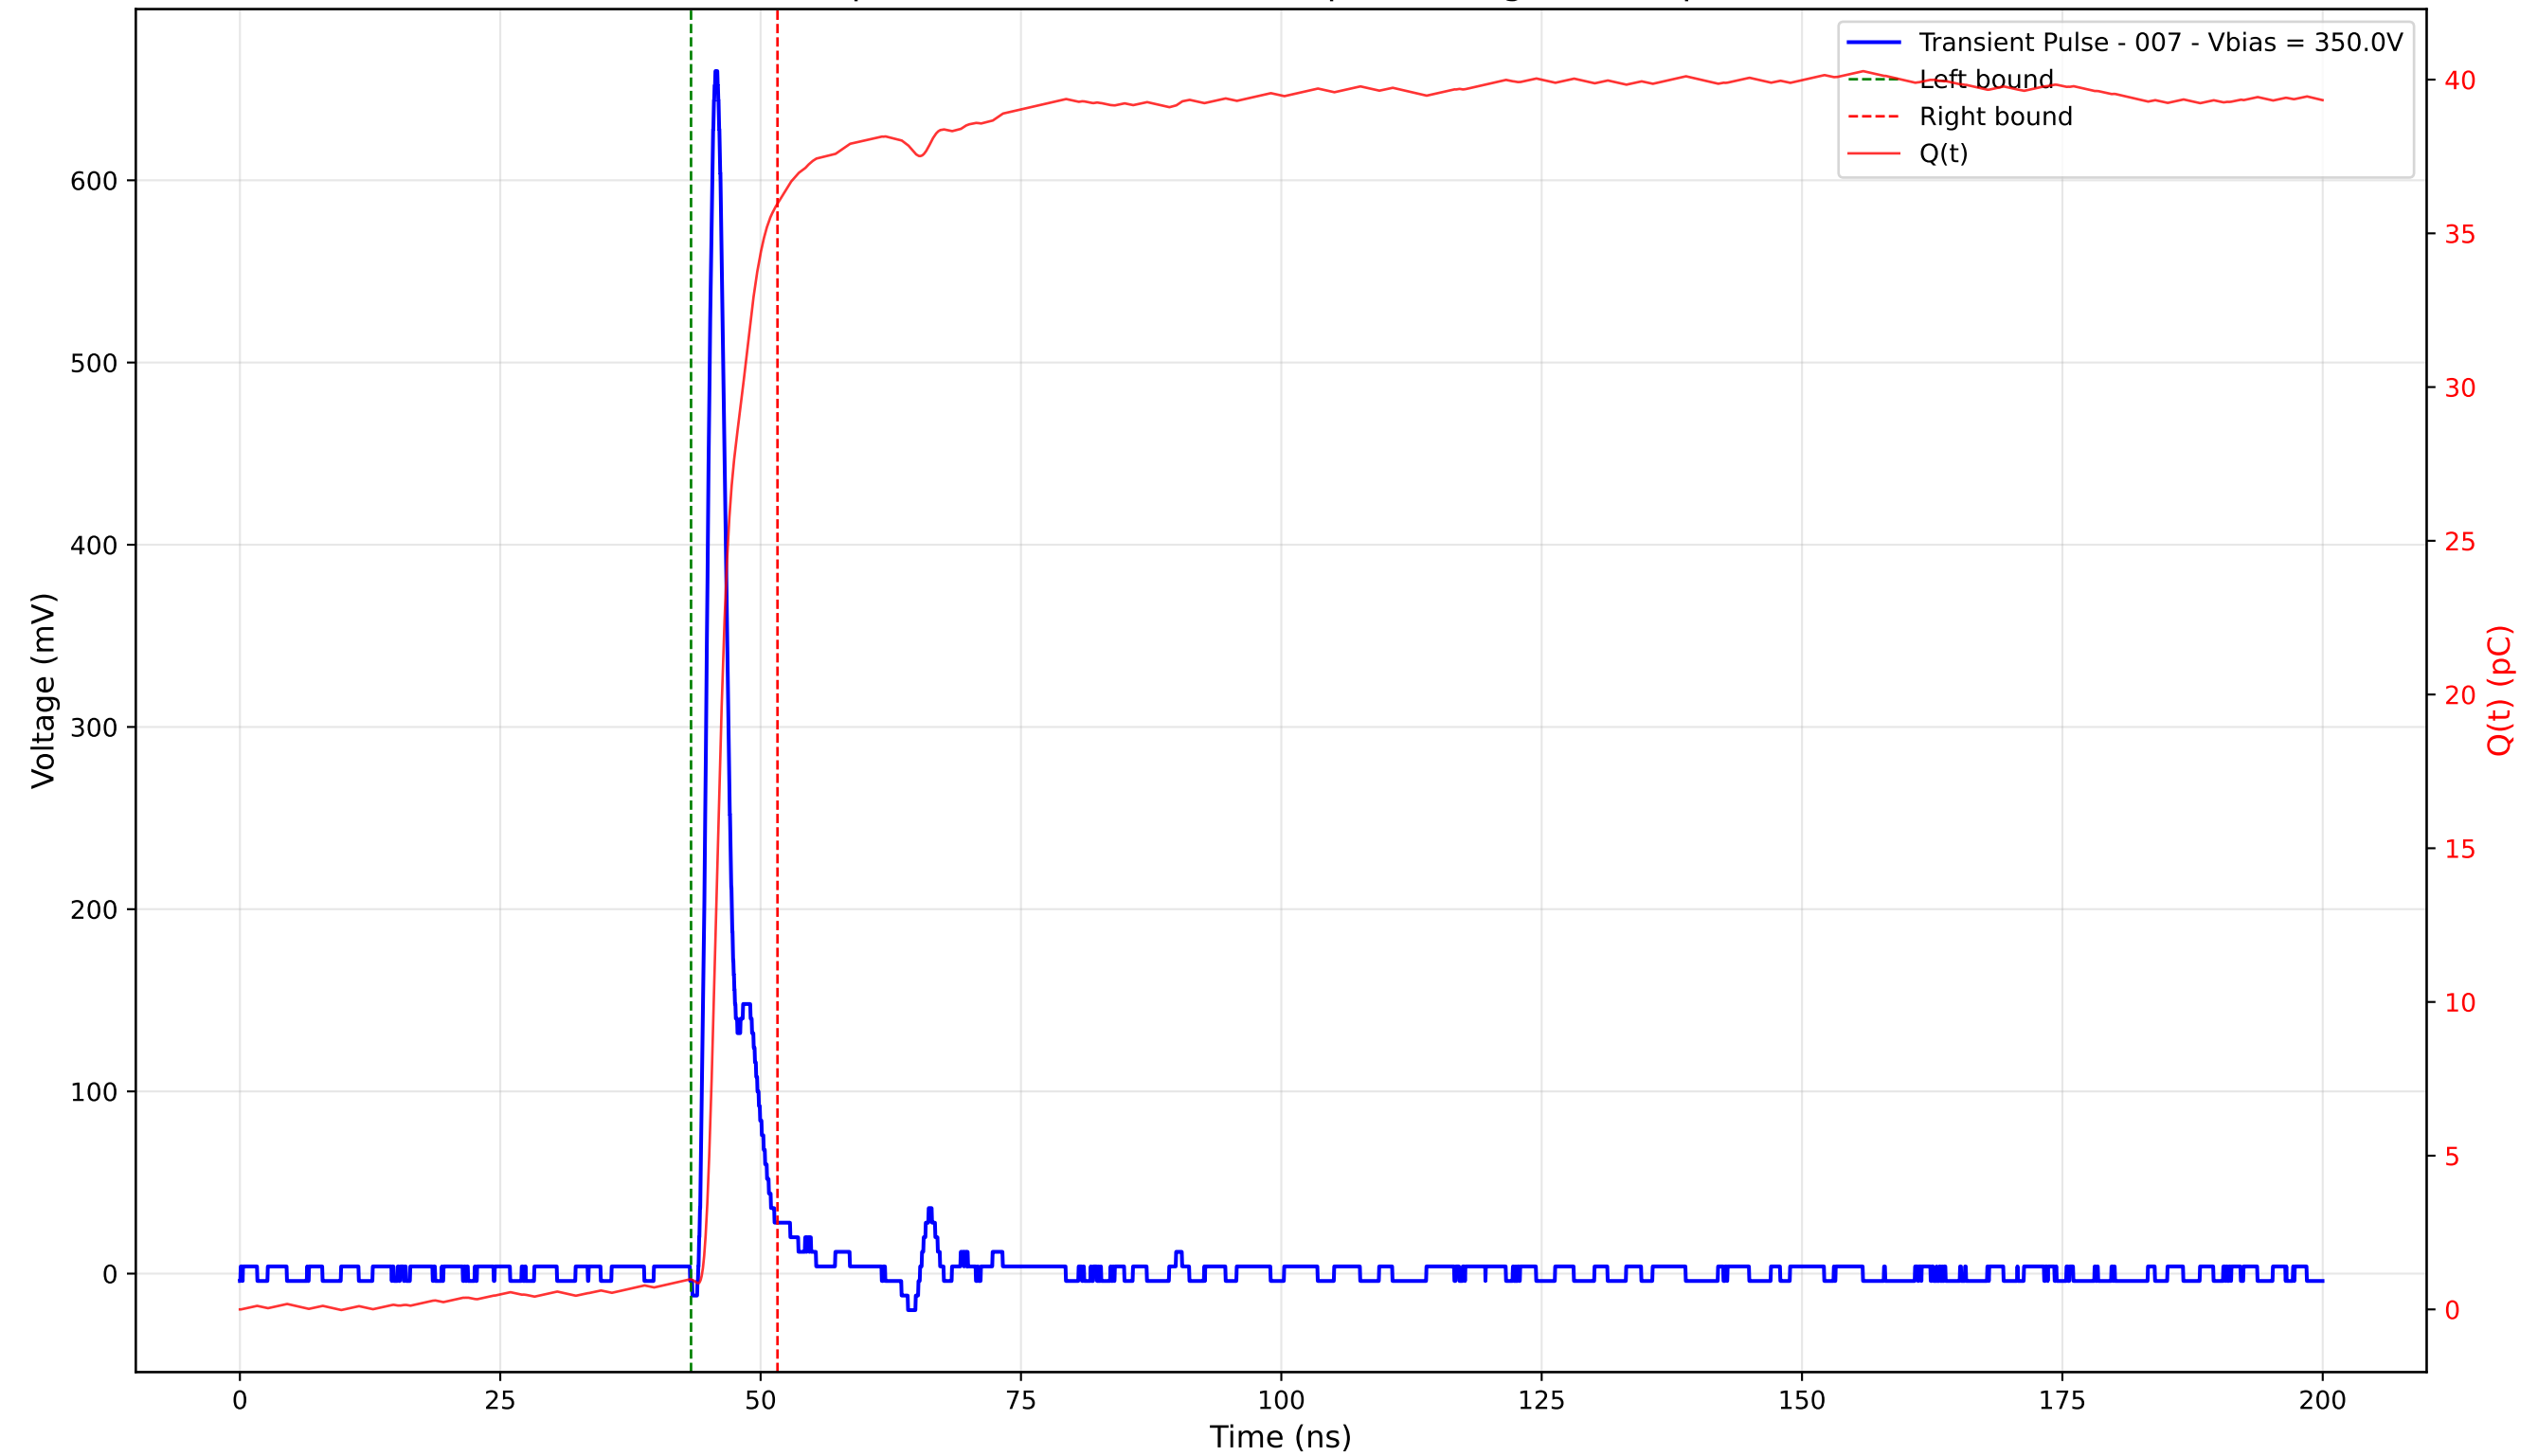


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 35.10 pC - Rise Time: 1.07 ns

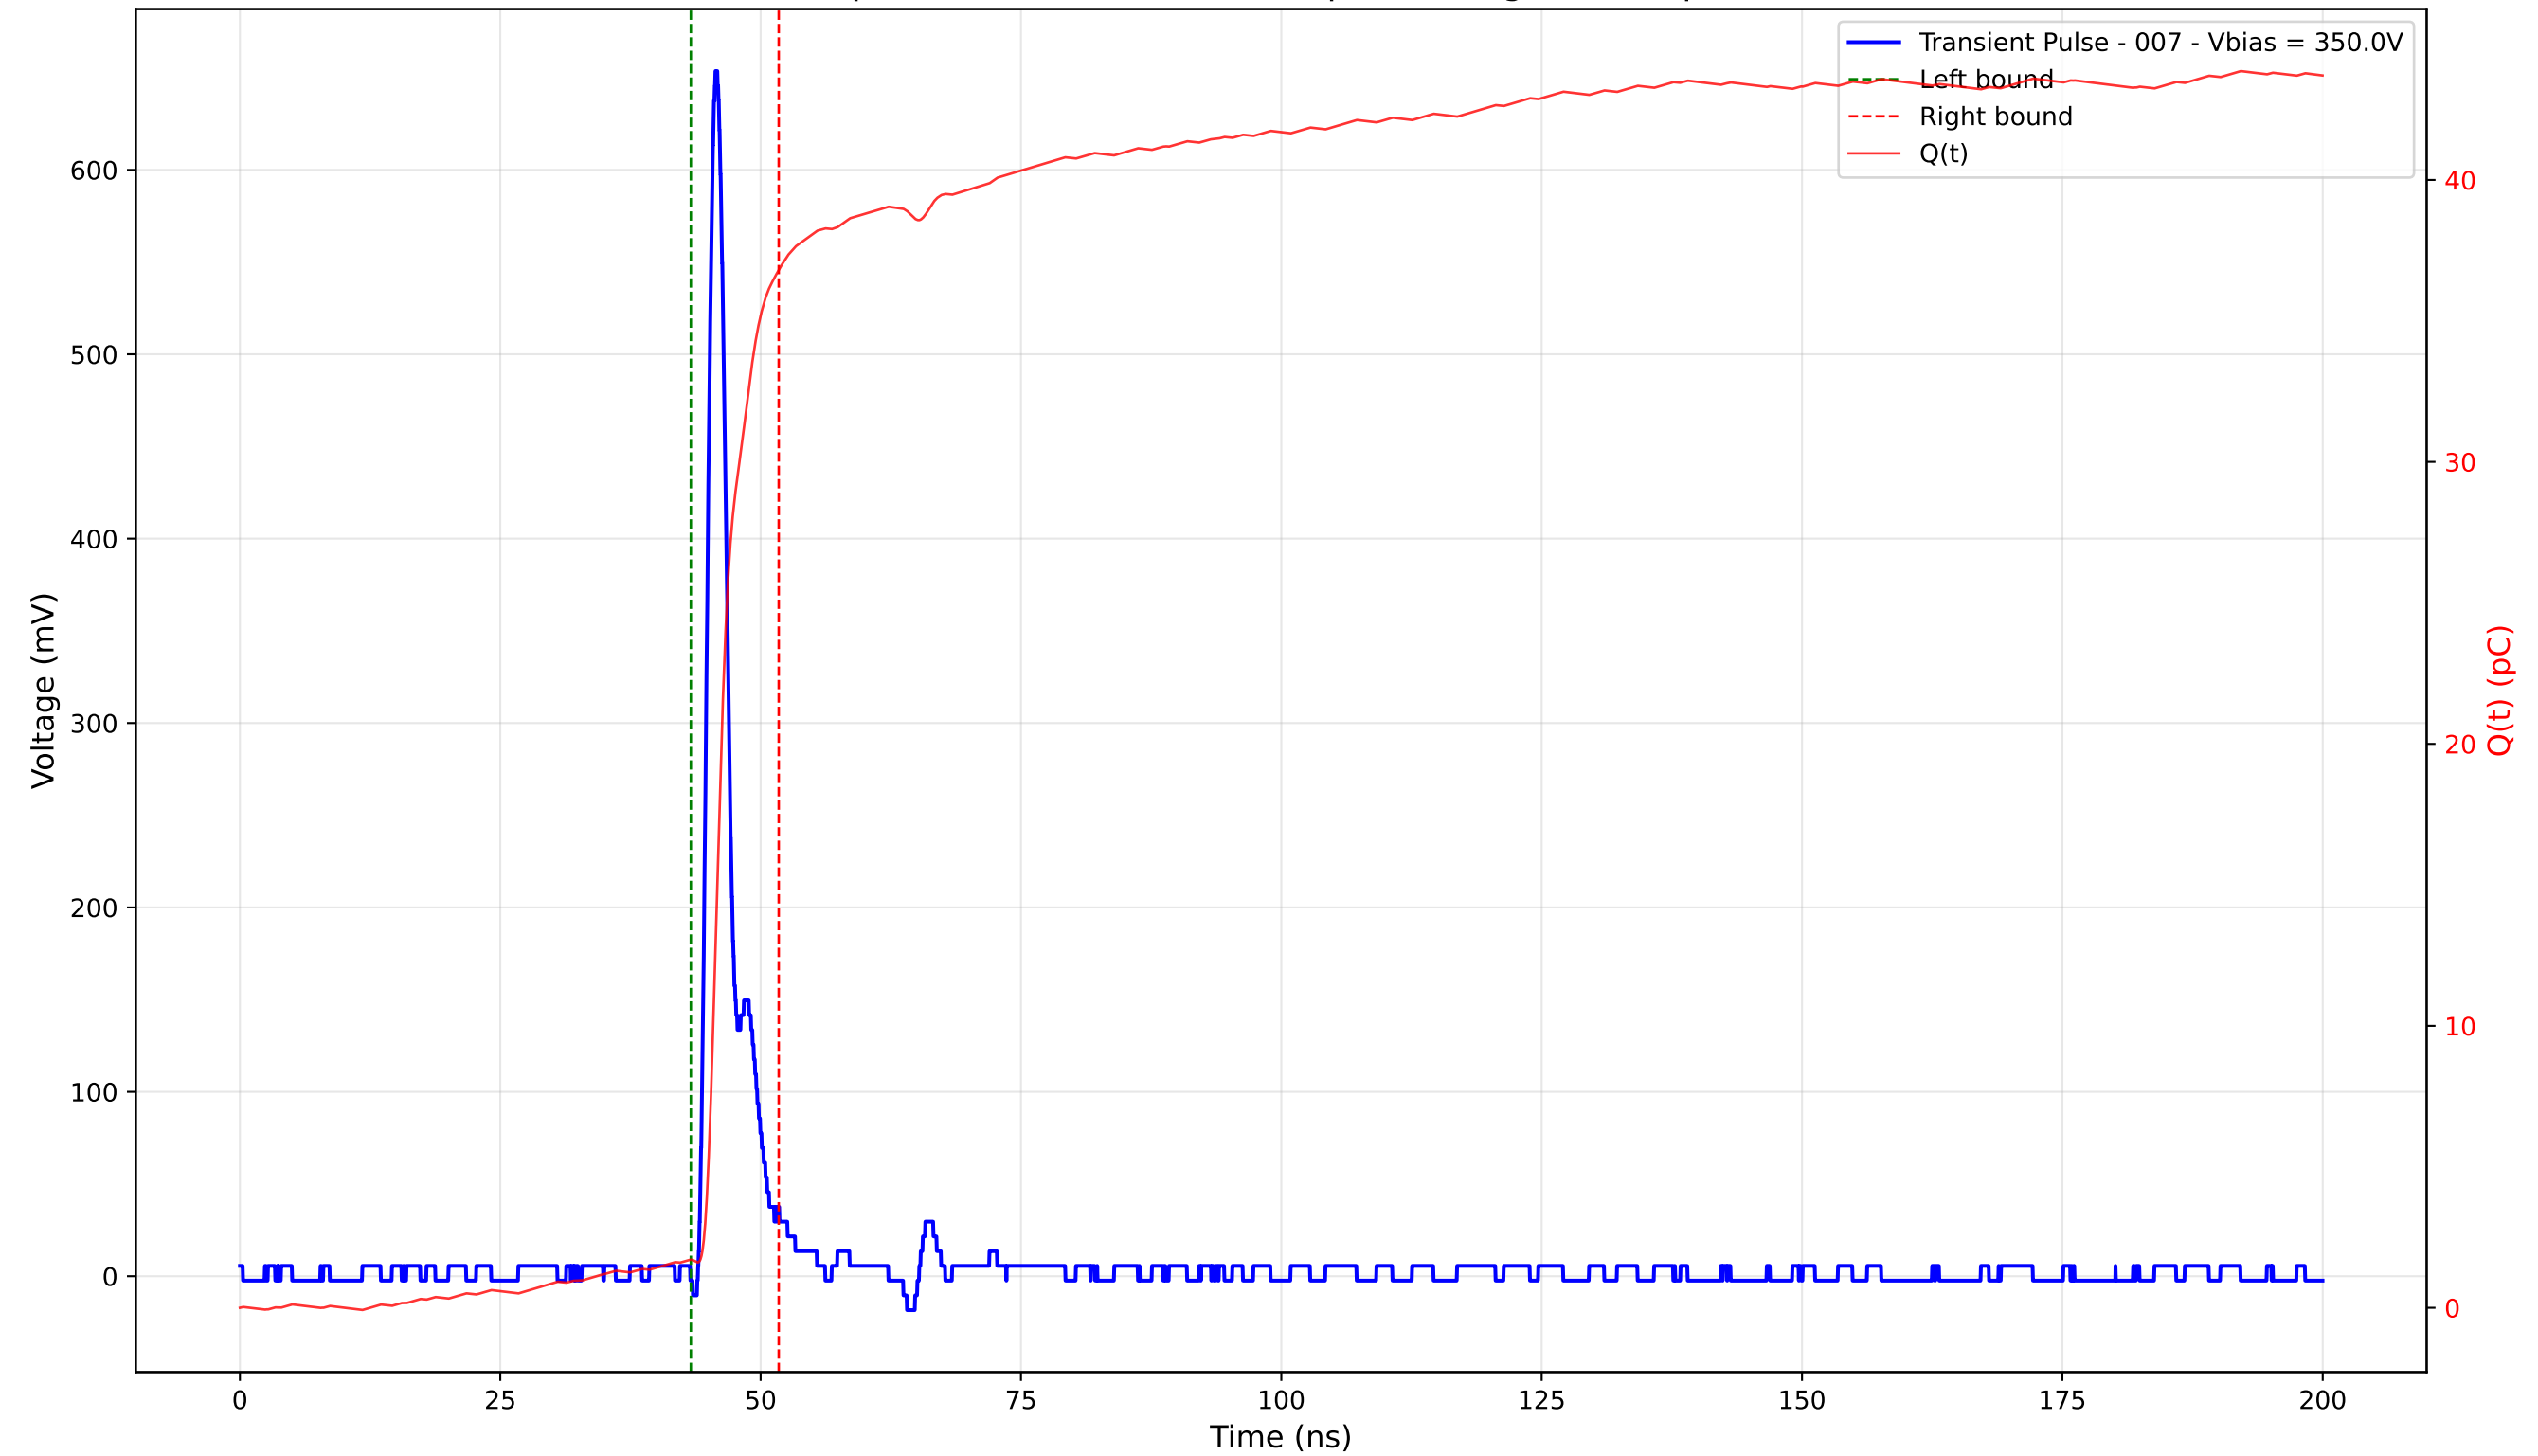


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 34.27 pC - Rise Time: 1.05 ns

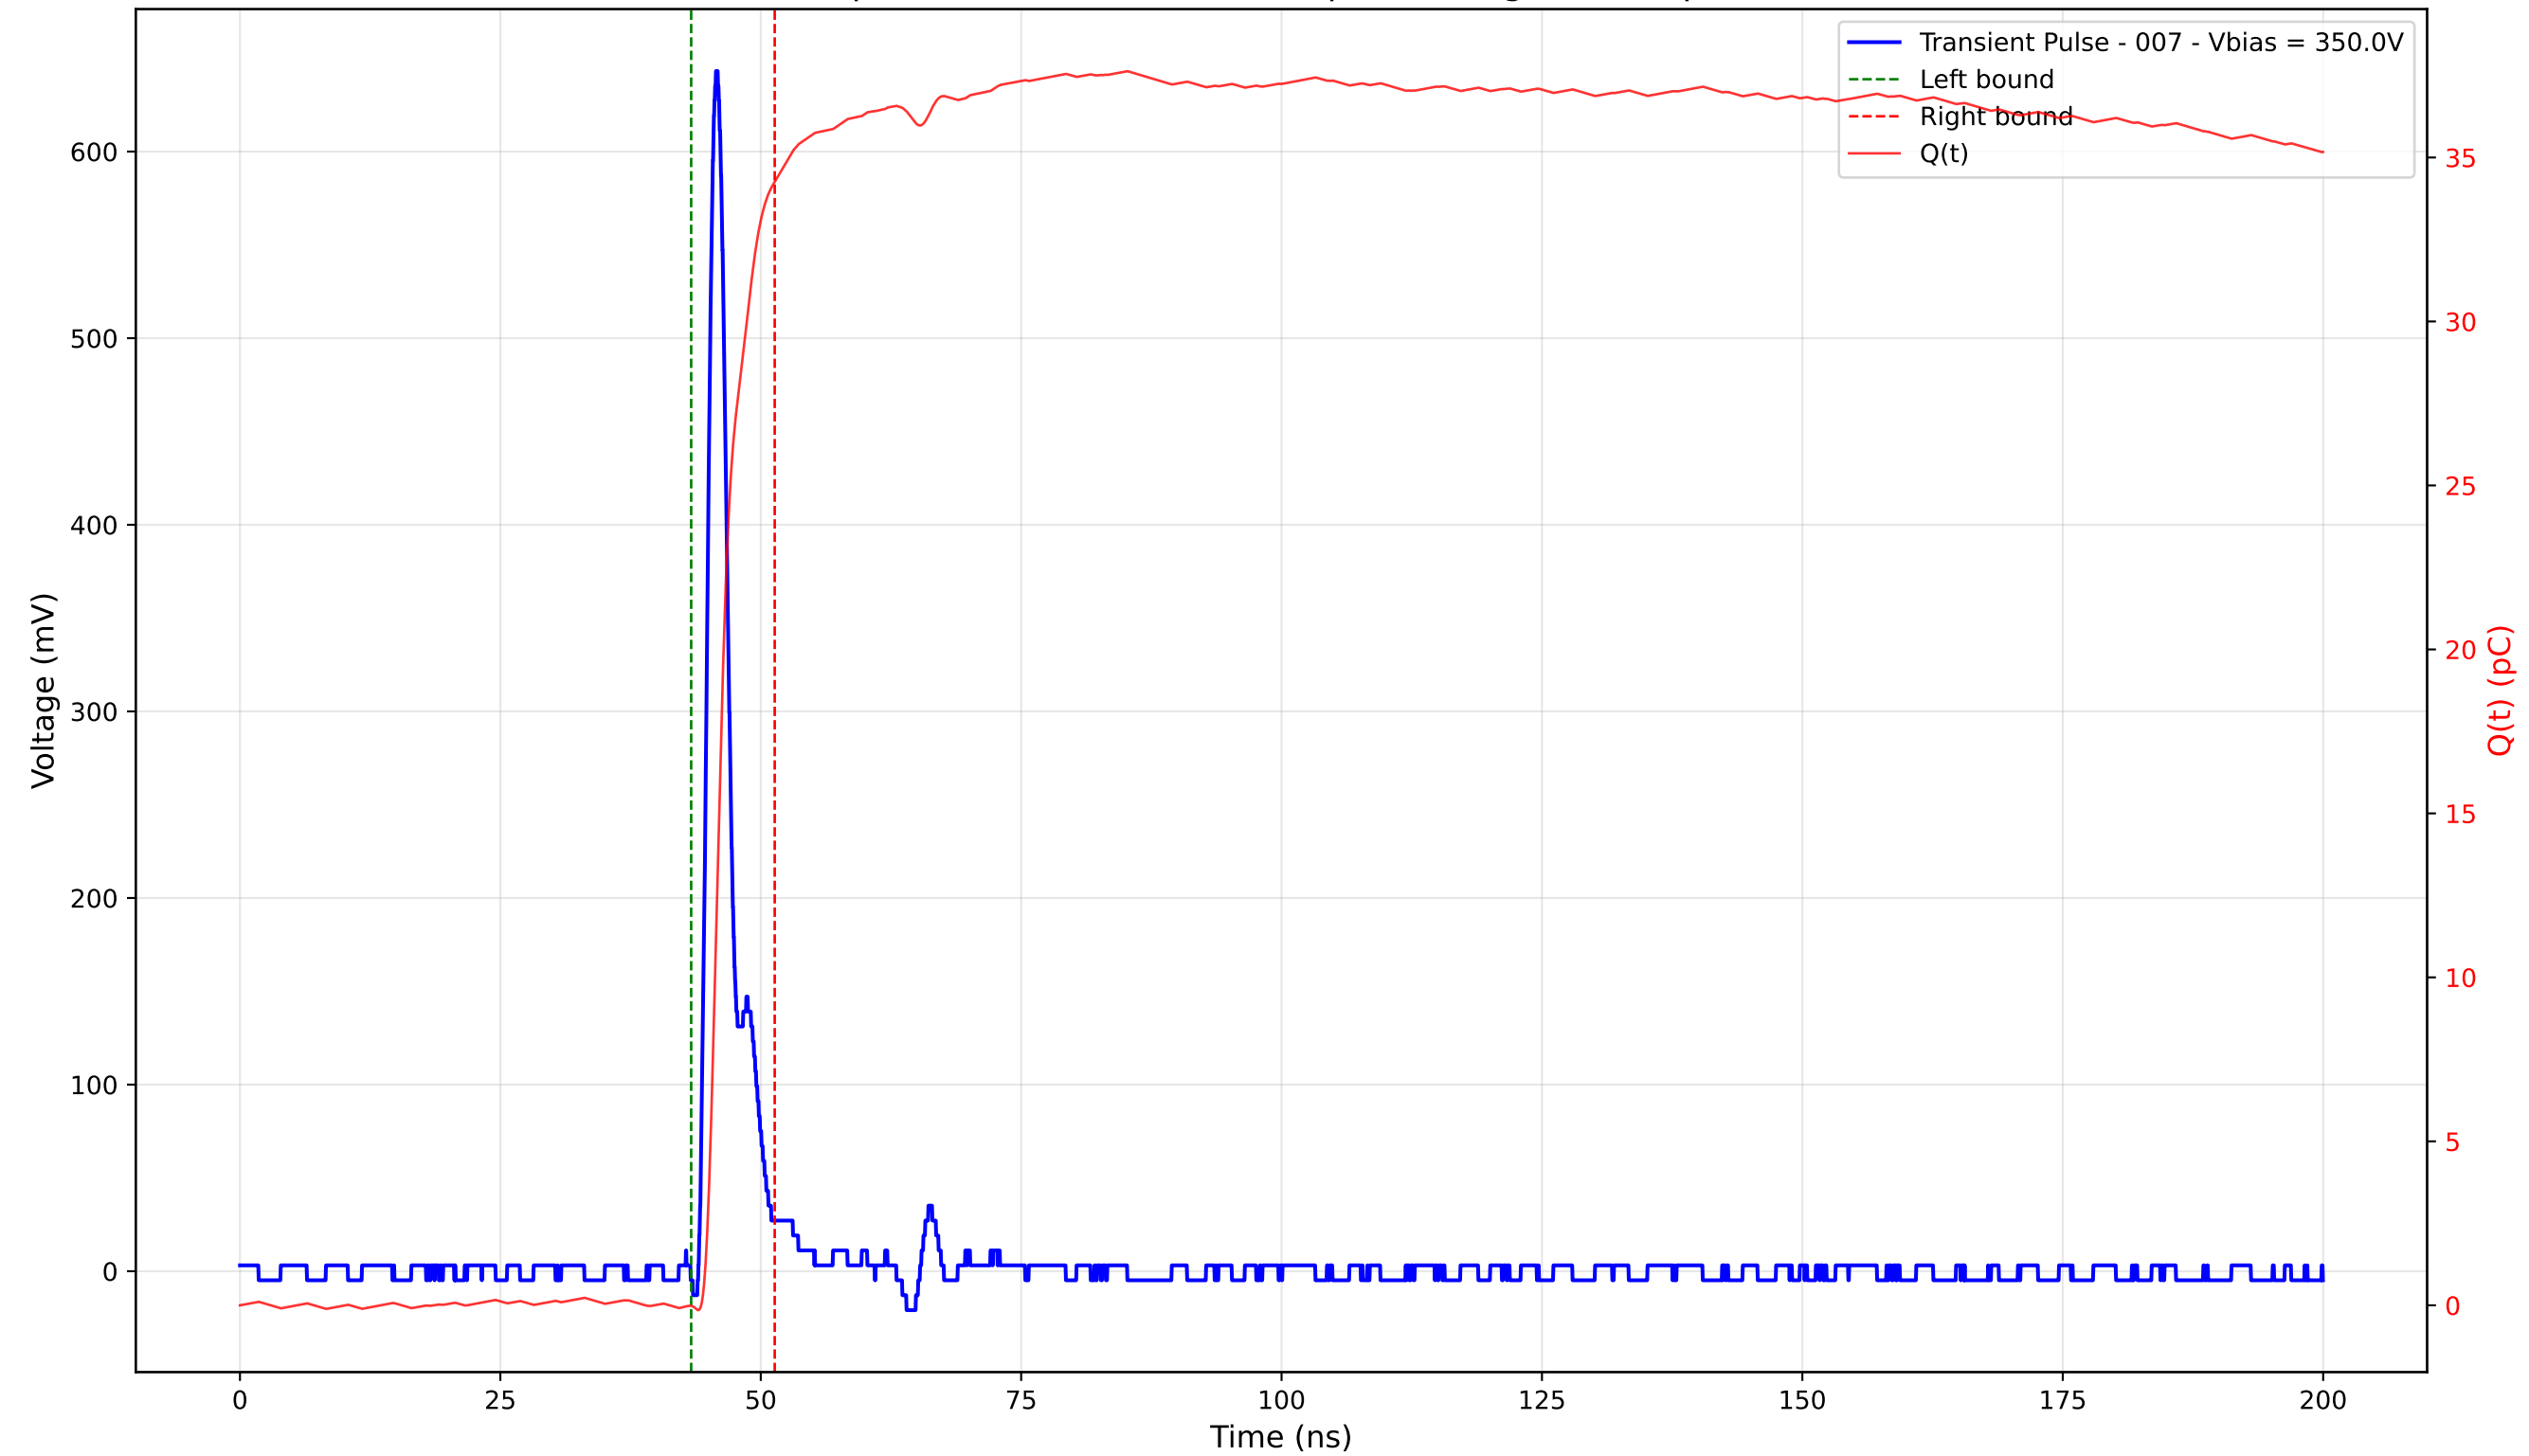


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 34.50 pC - Rise Time: 1.08 ns

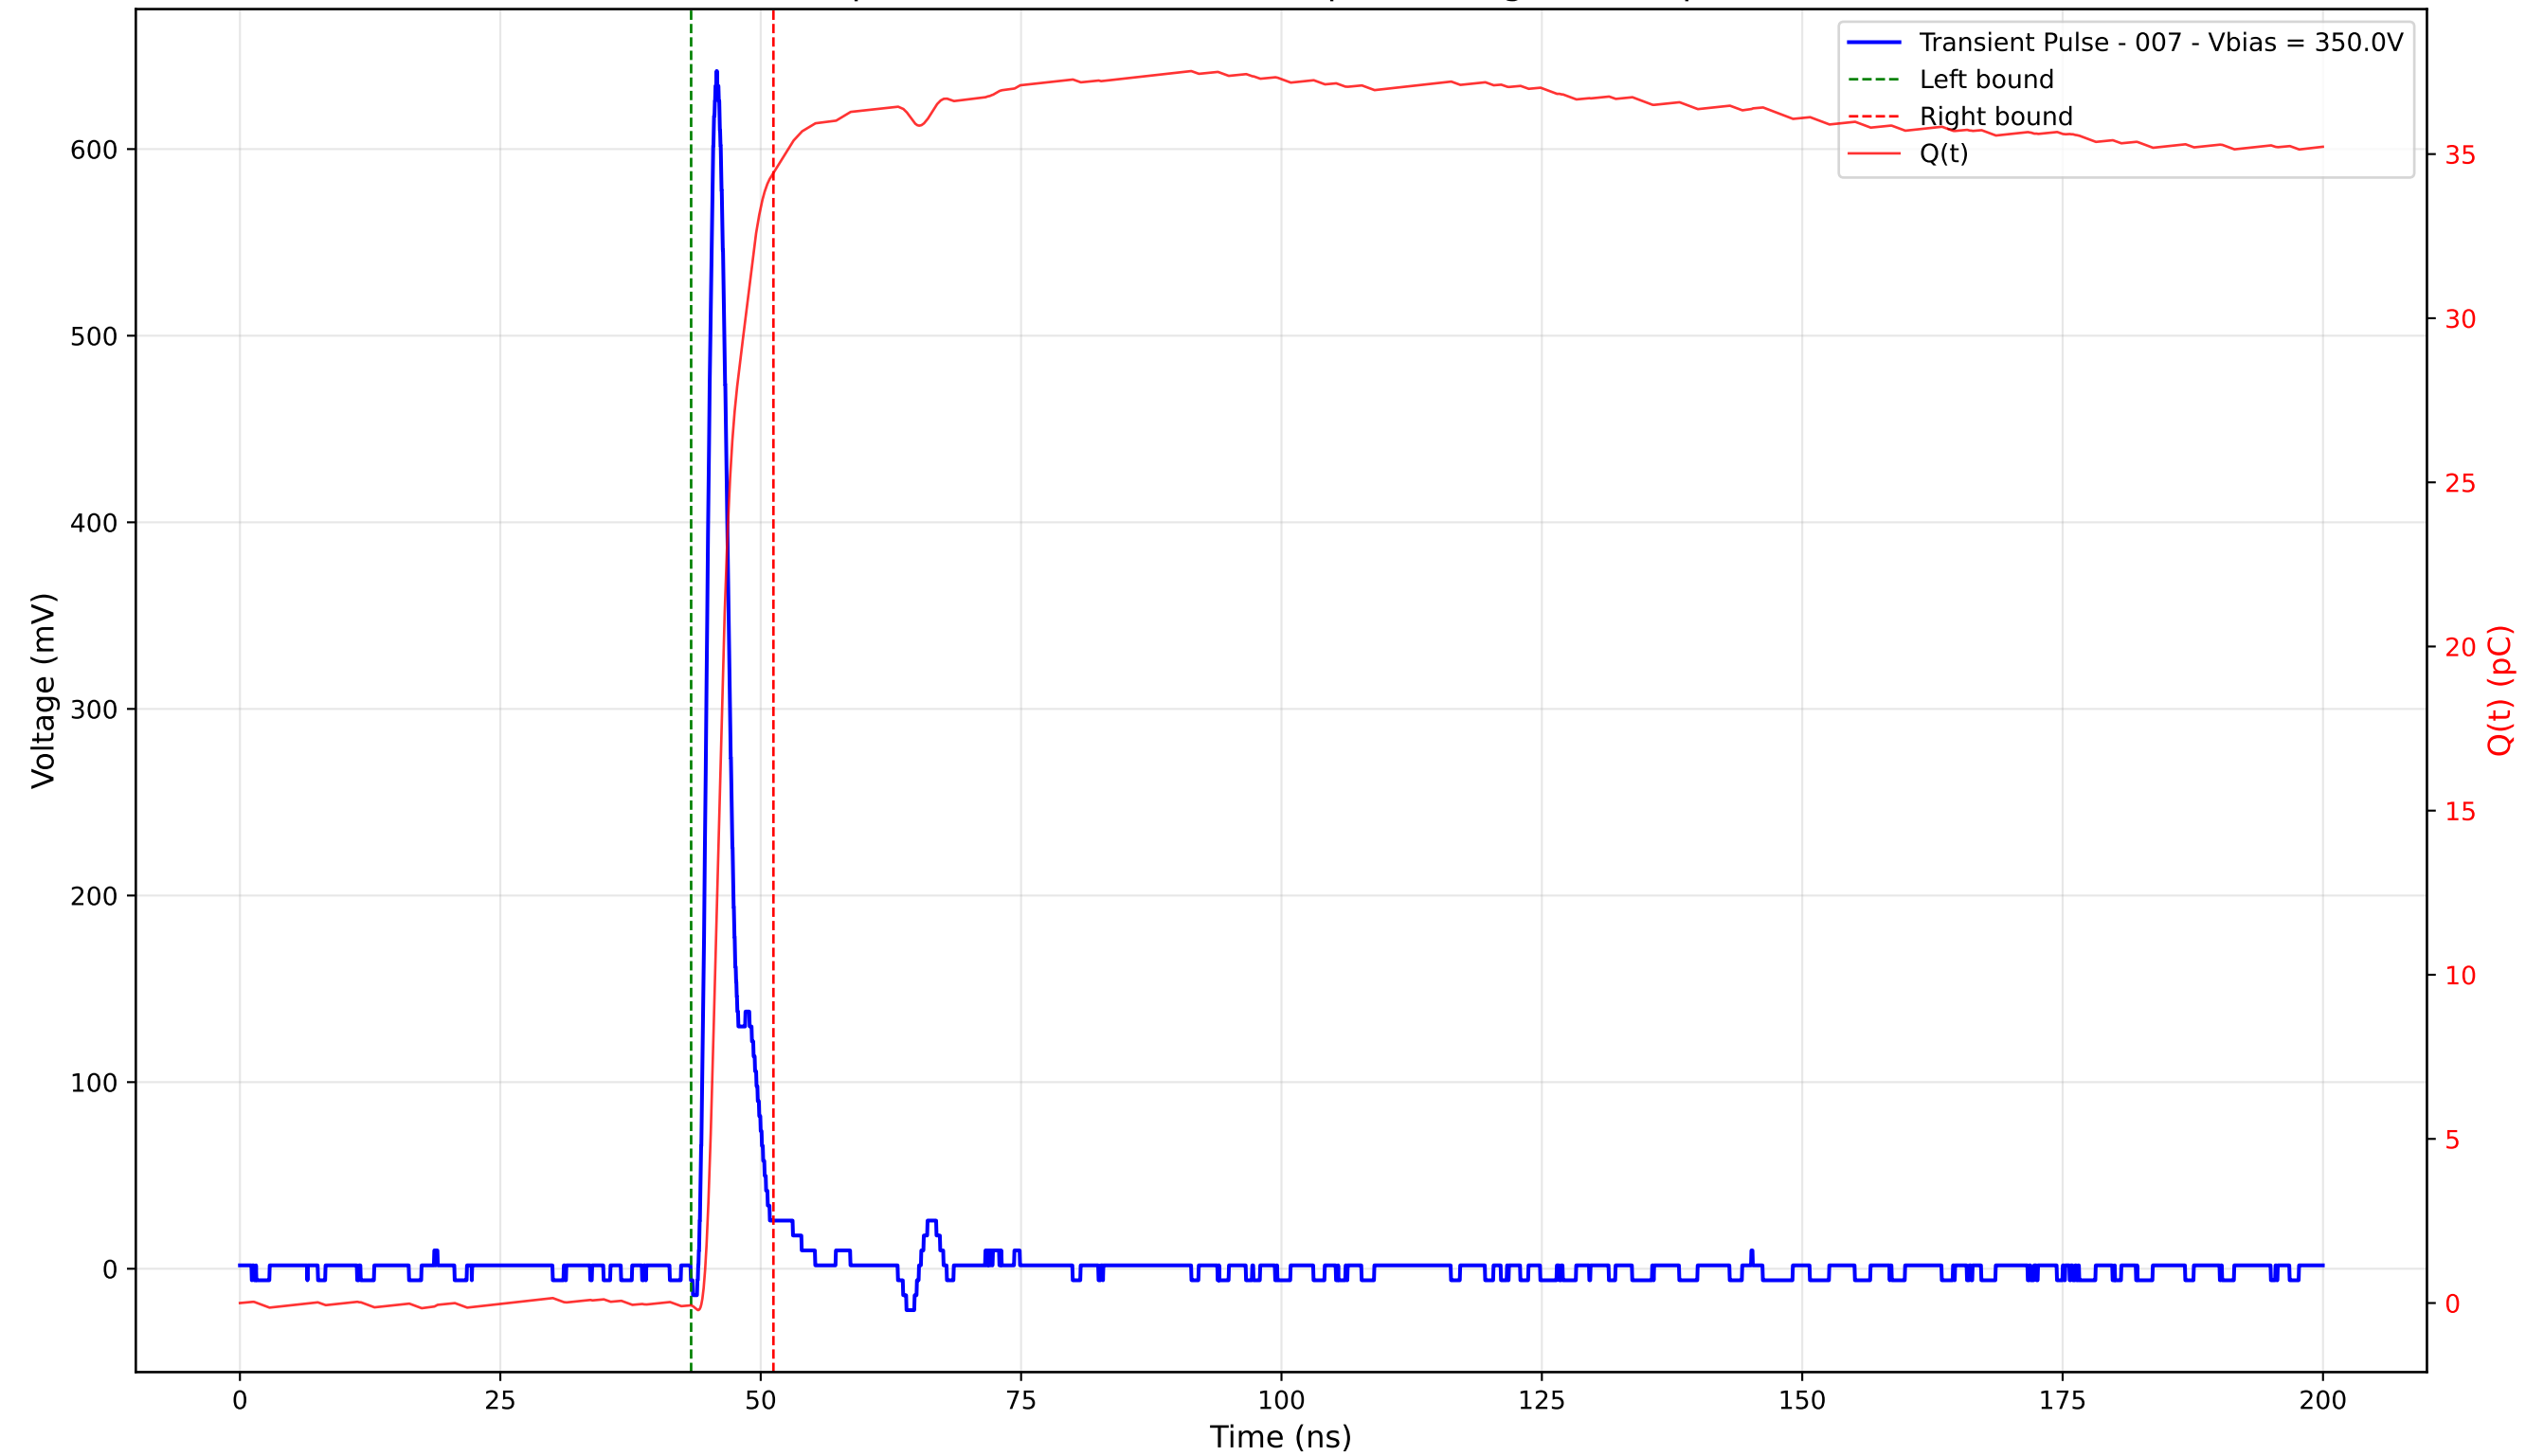


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 34.66 pC - Rise Time: 1.09 ns

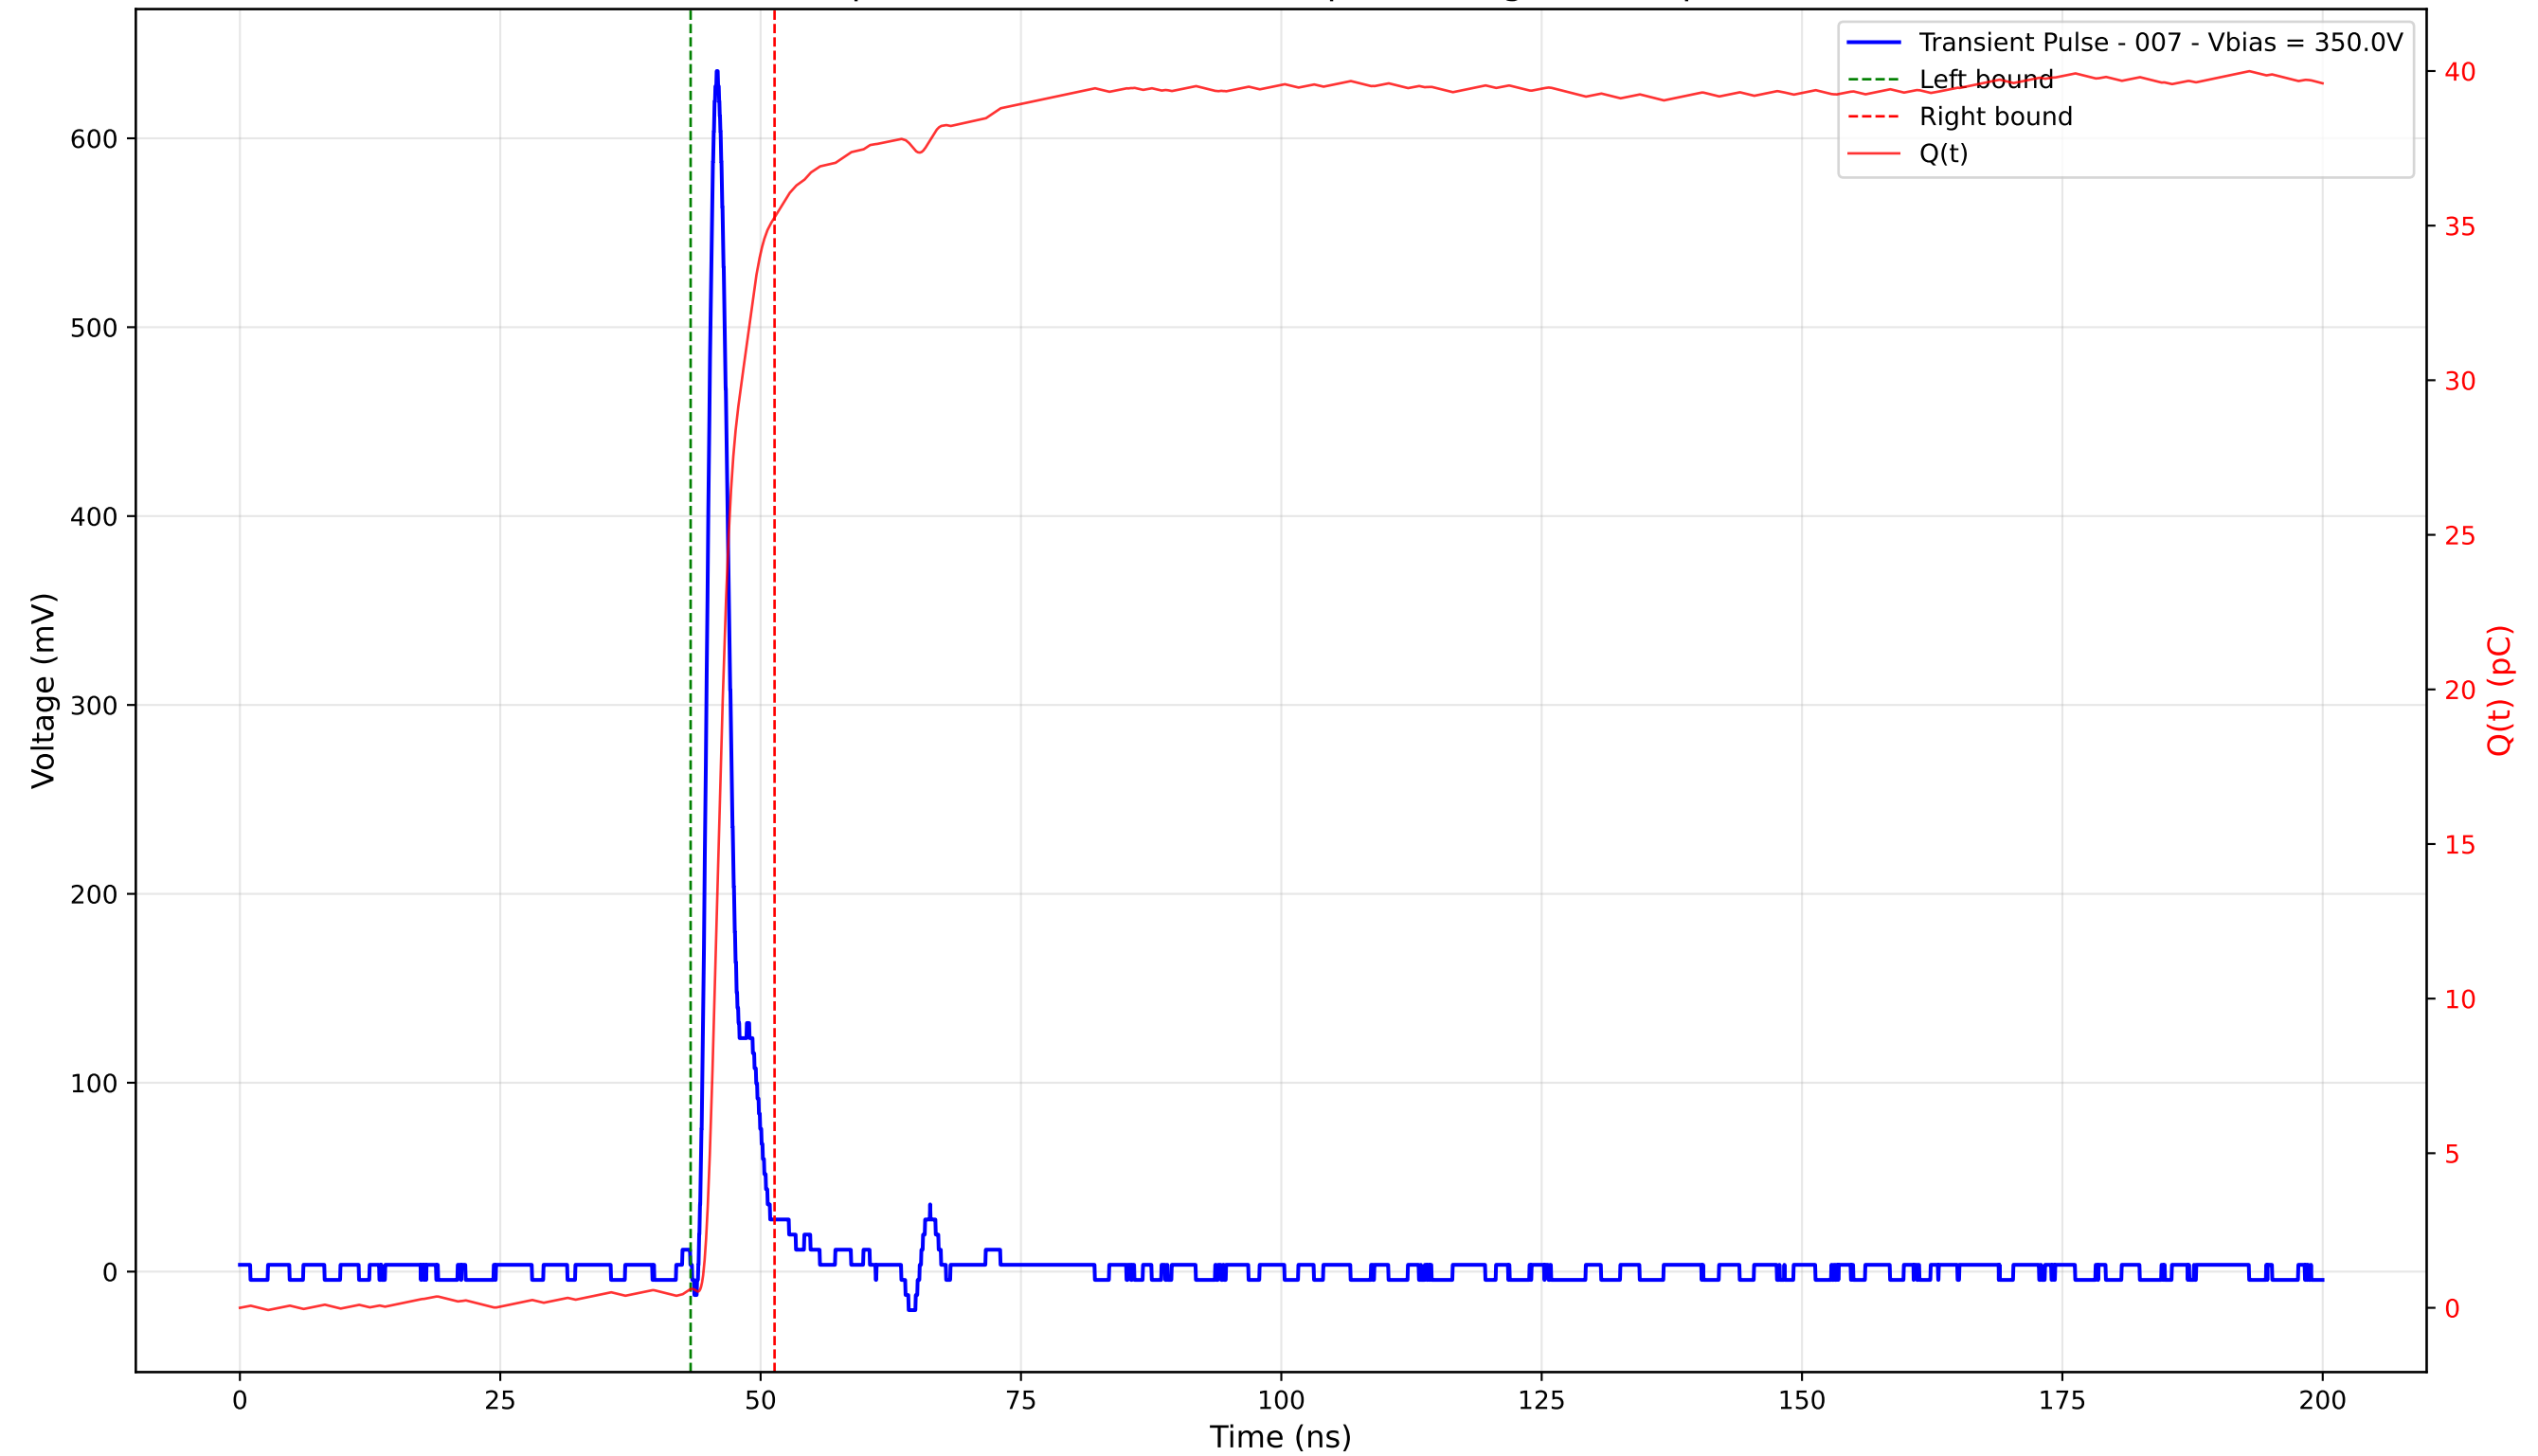


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 33.95 pC - Rise Time: 1.08 ns

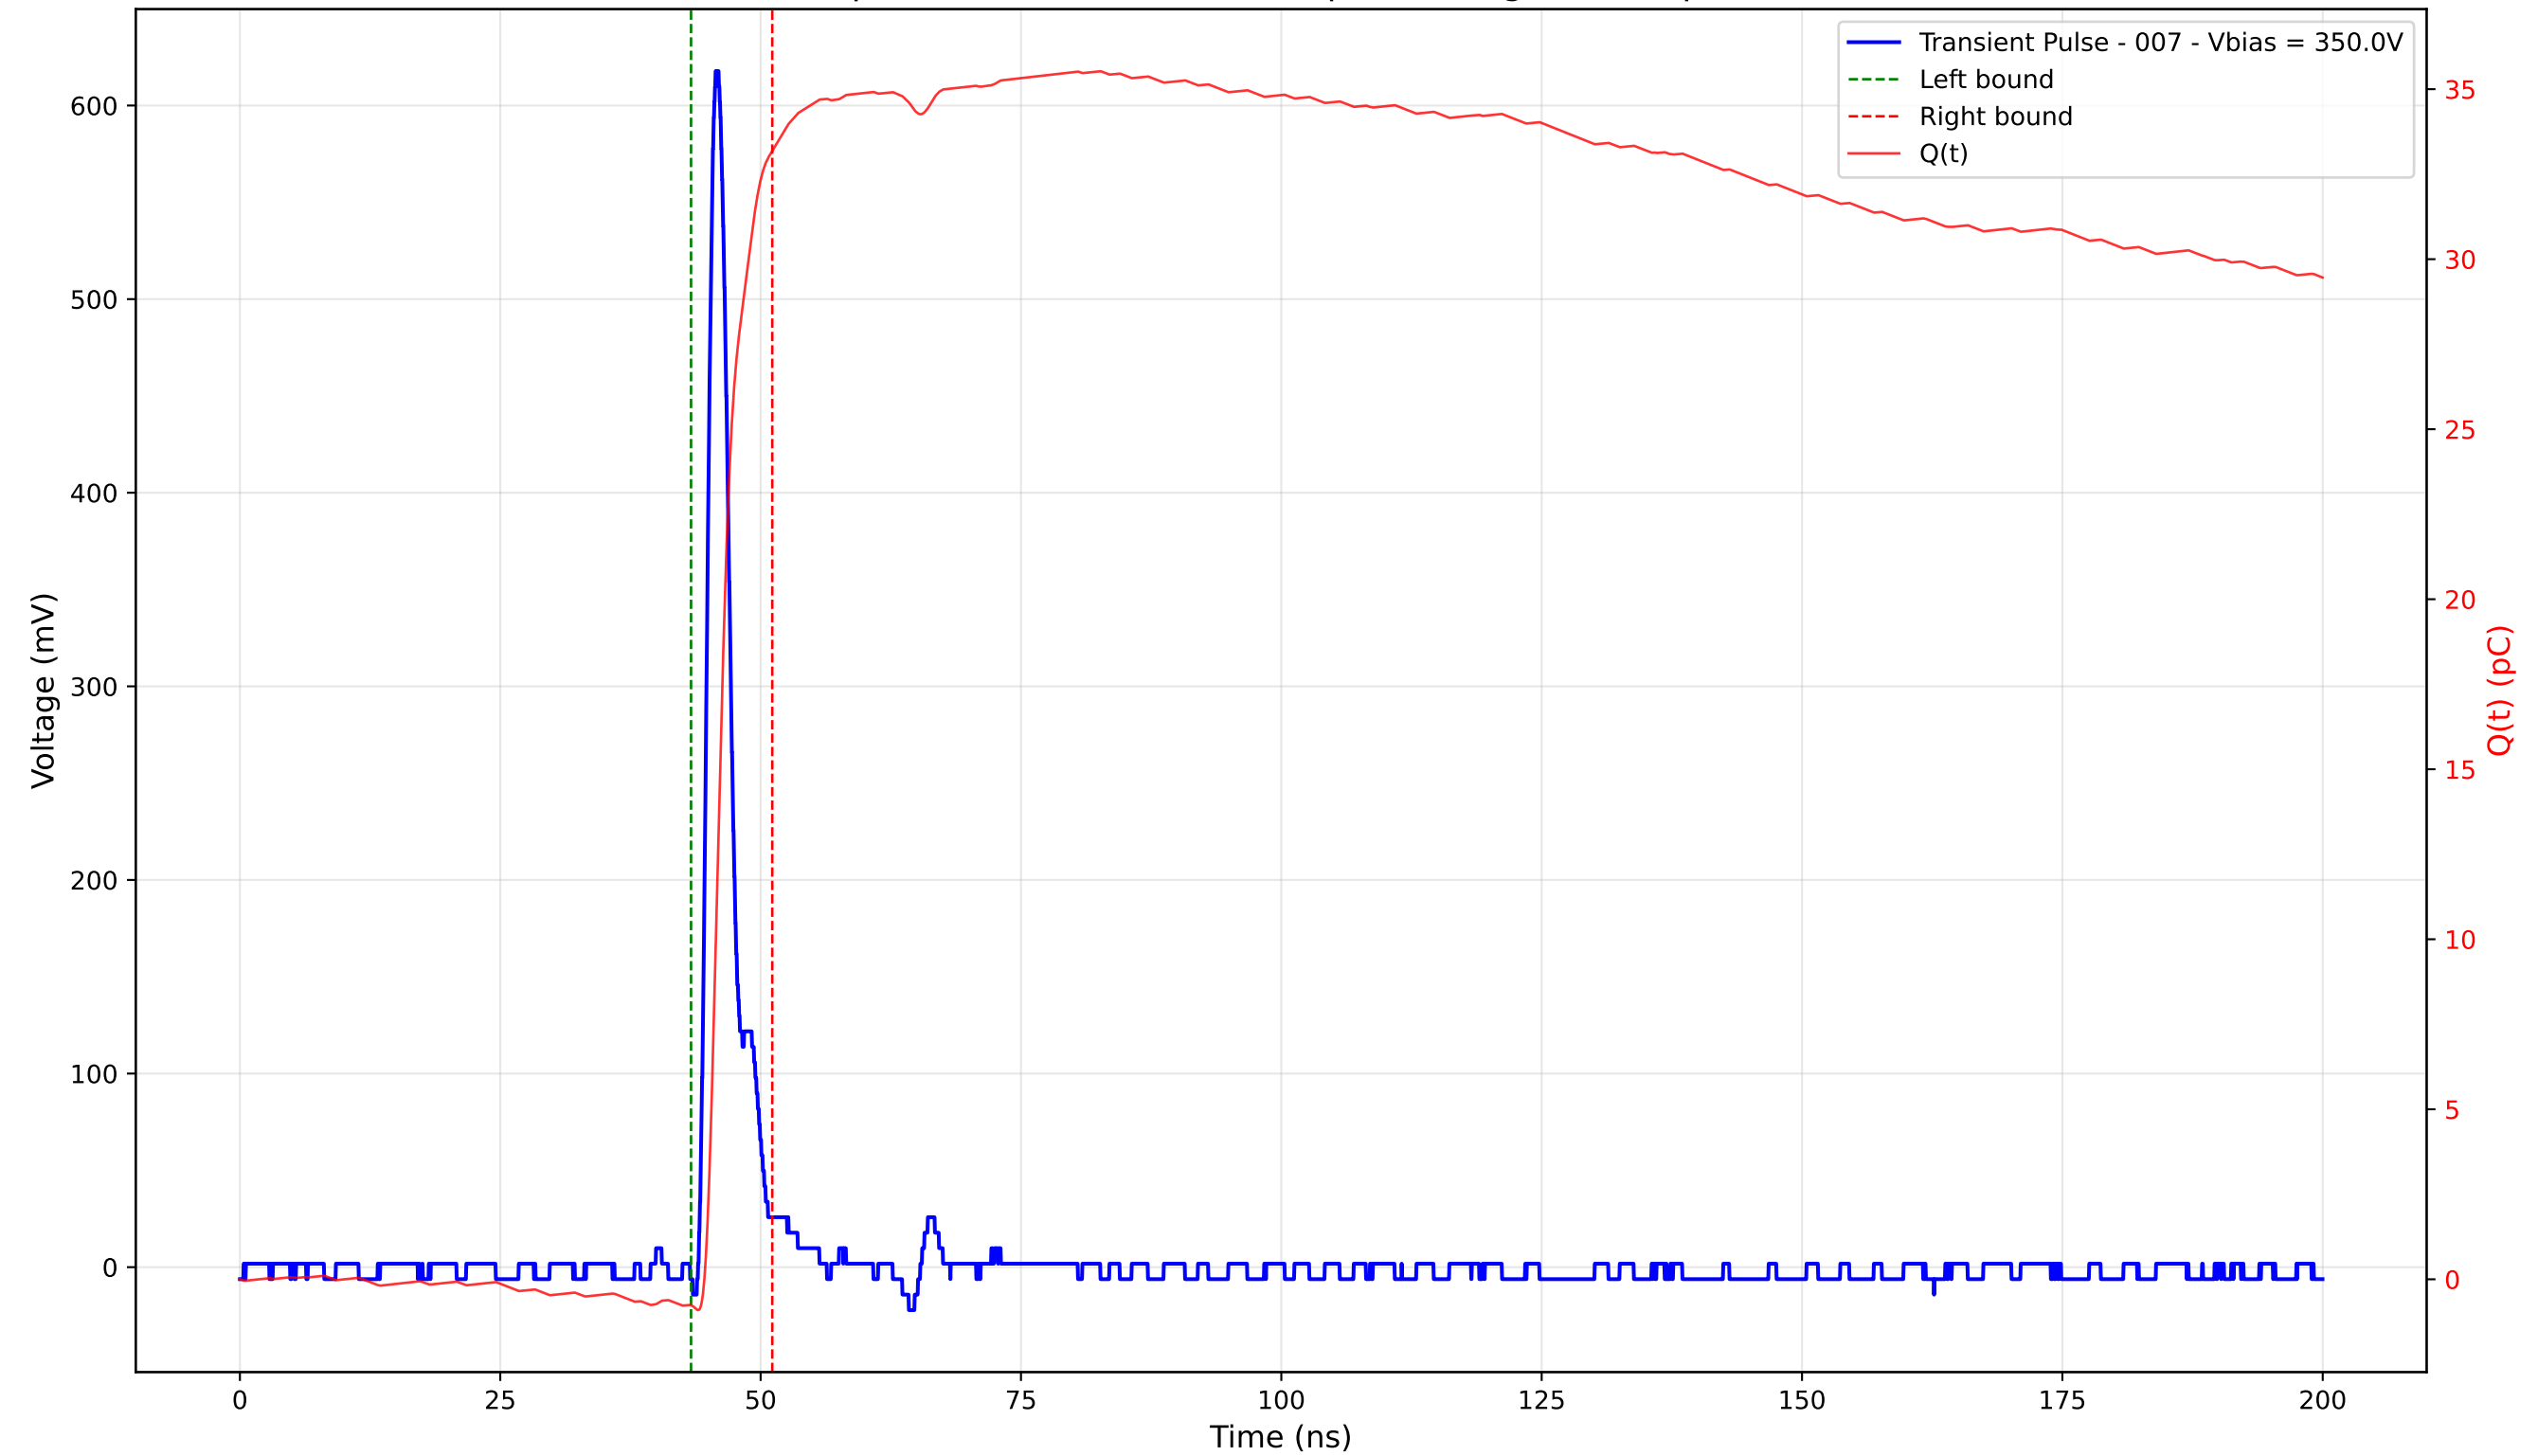


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 34.30 pC - Rise Time: 1.11 ns

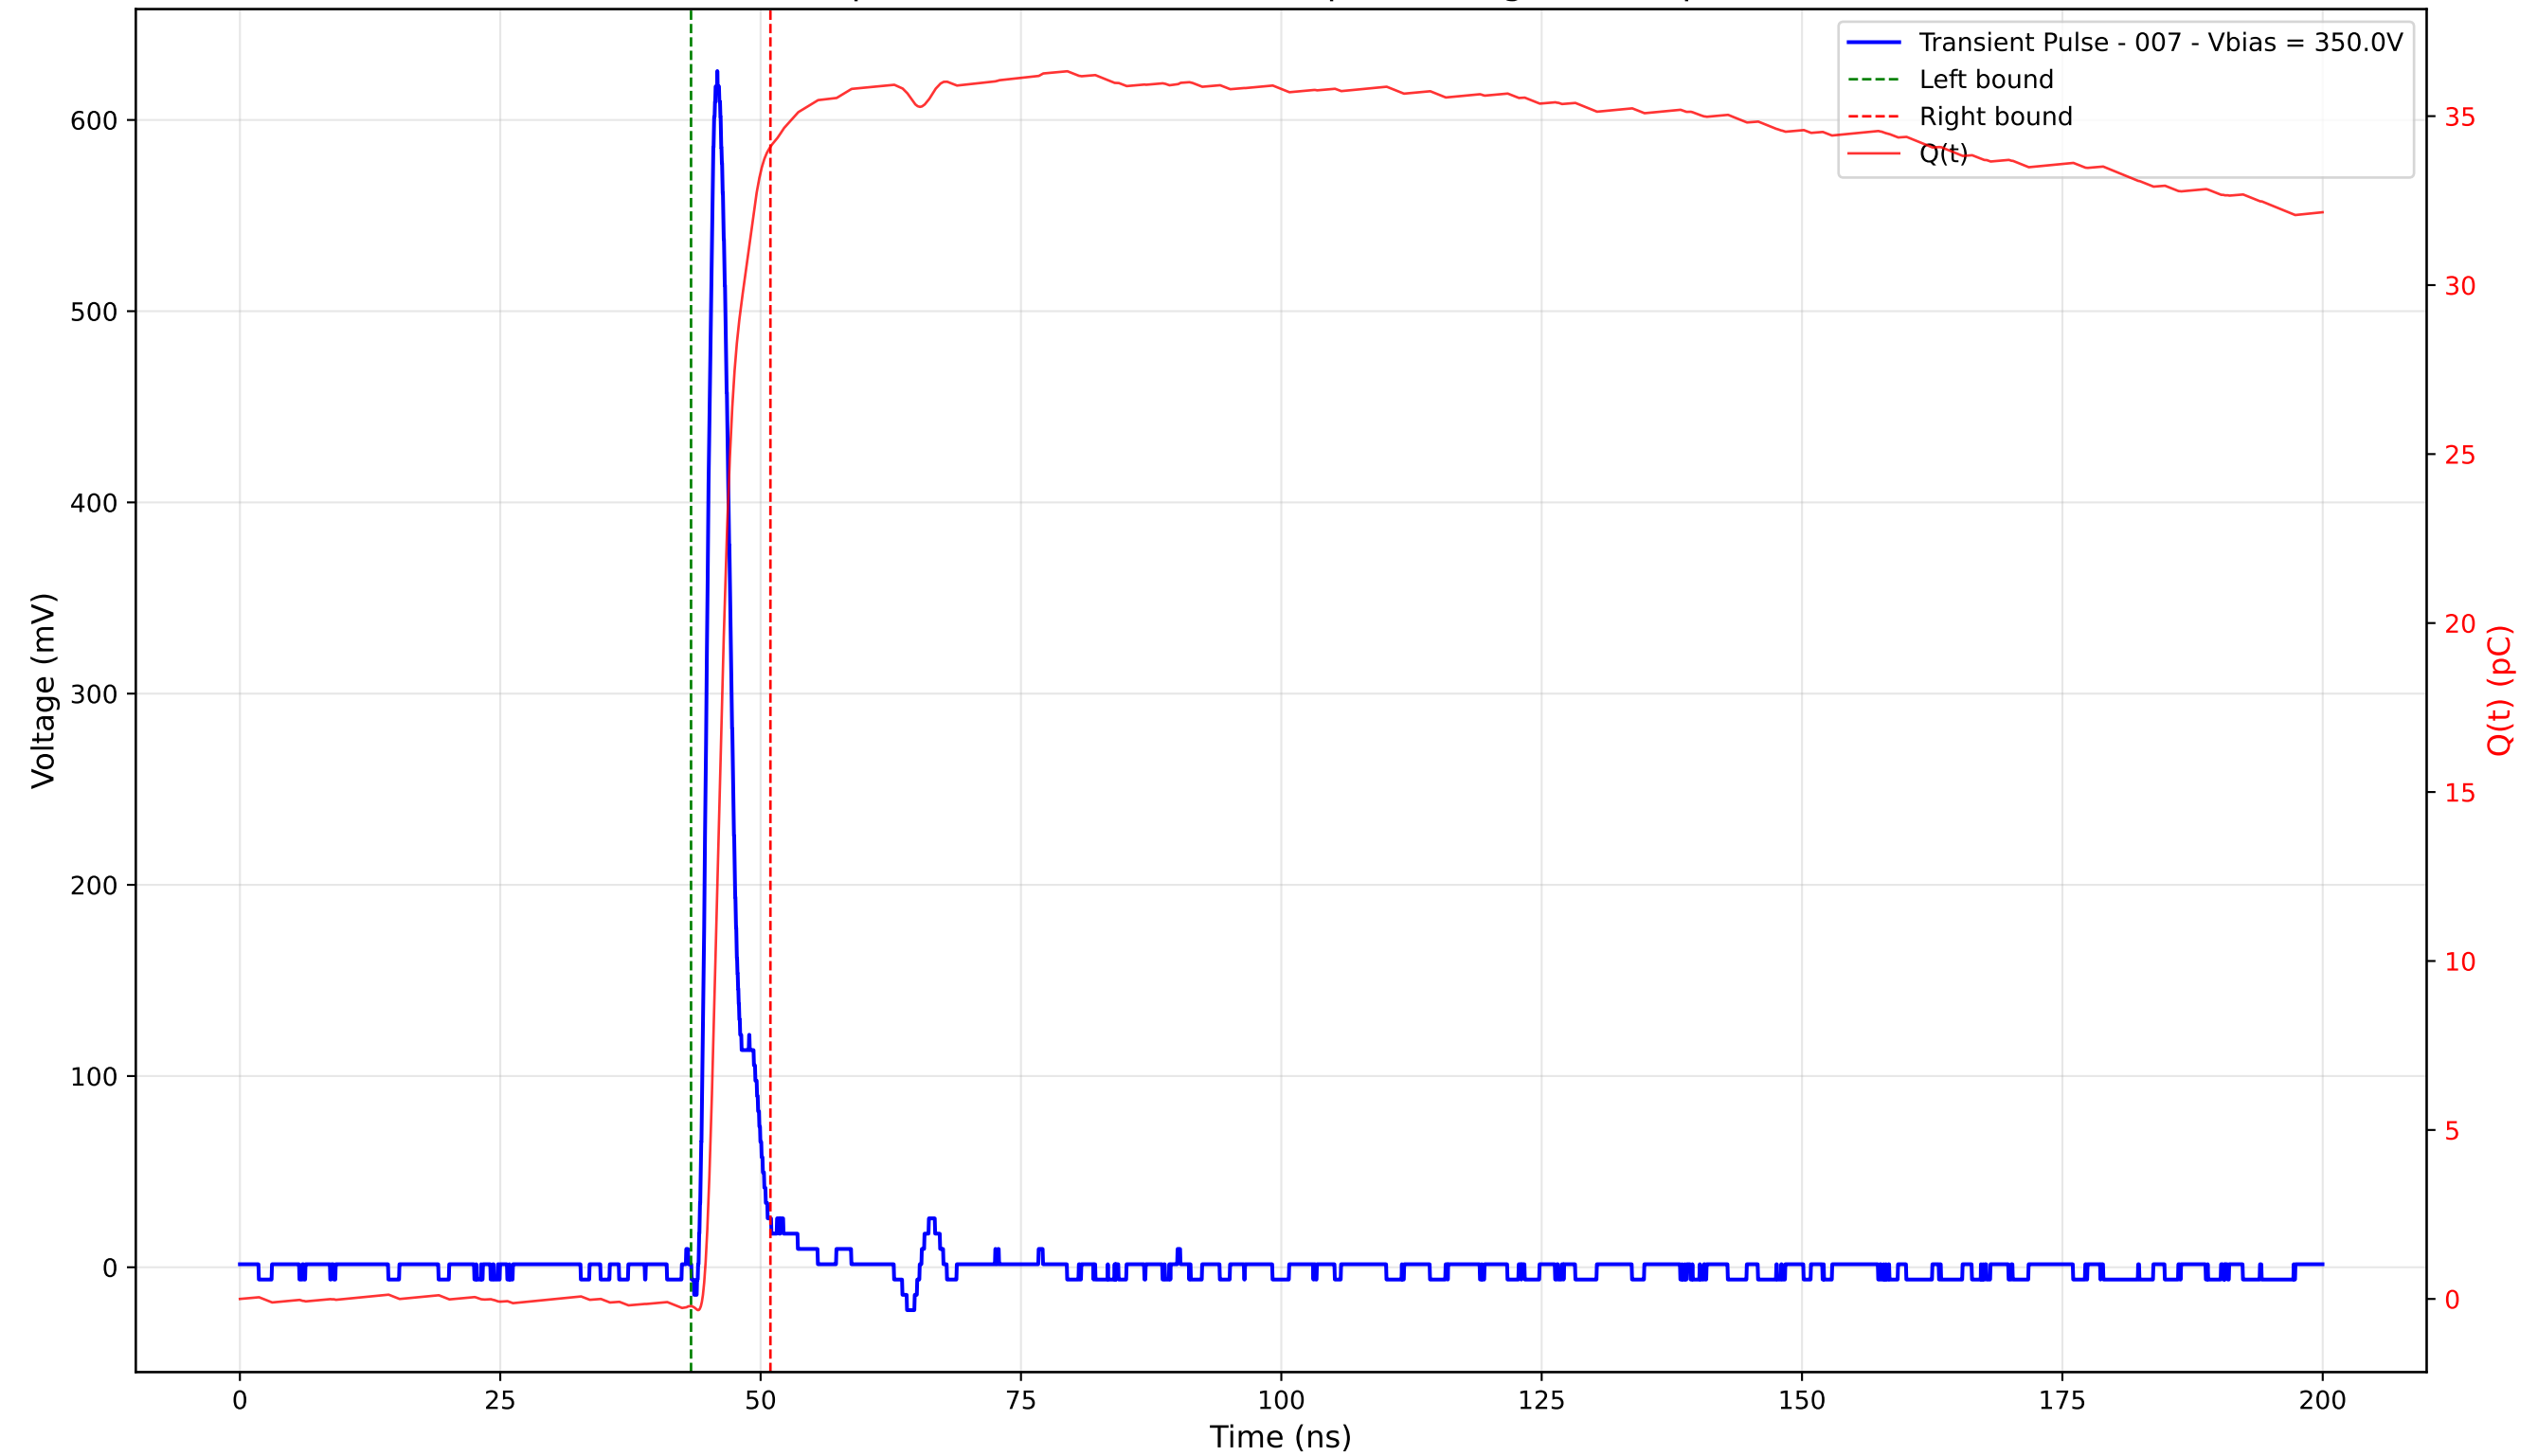


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 34.12 pC - Rise Time: 1.08 ns

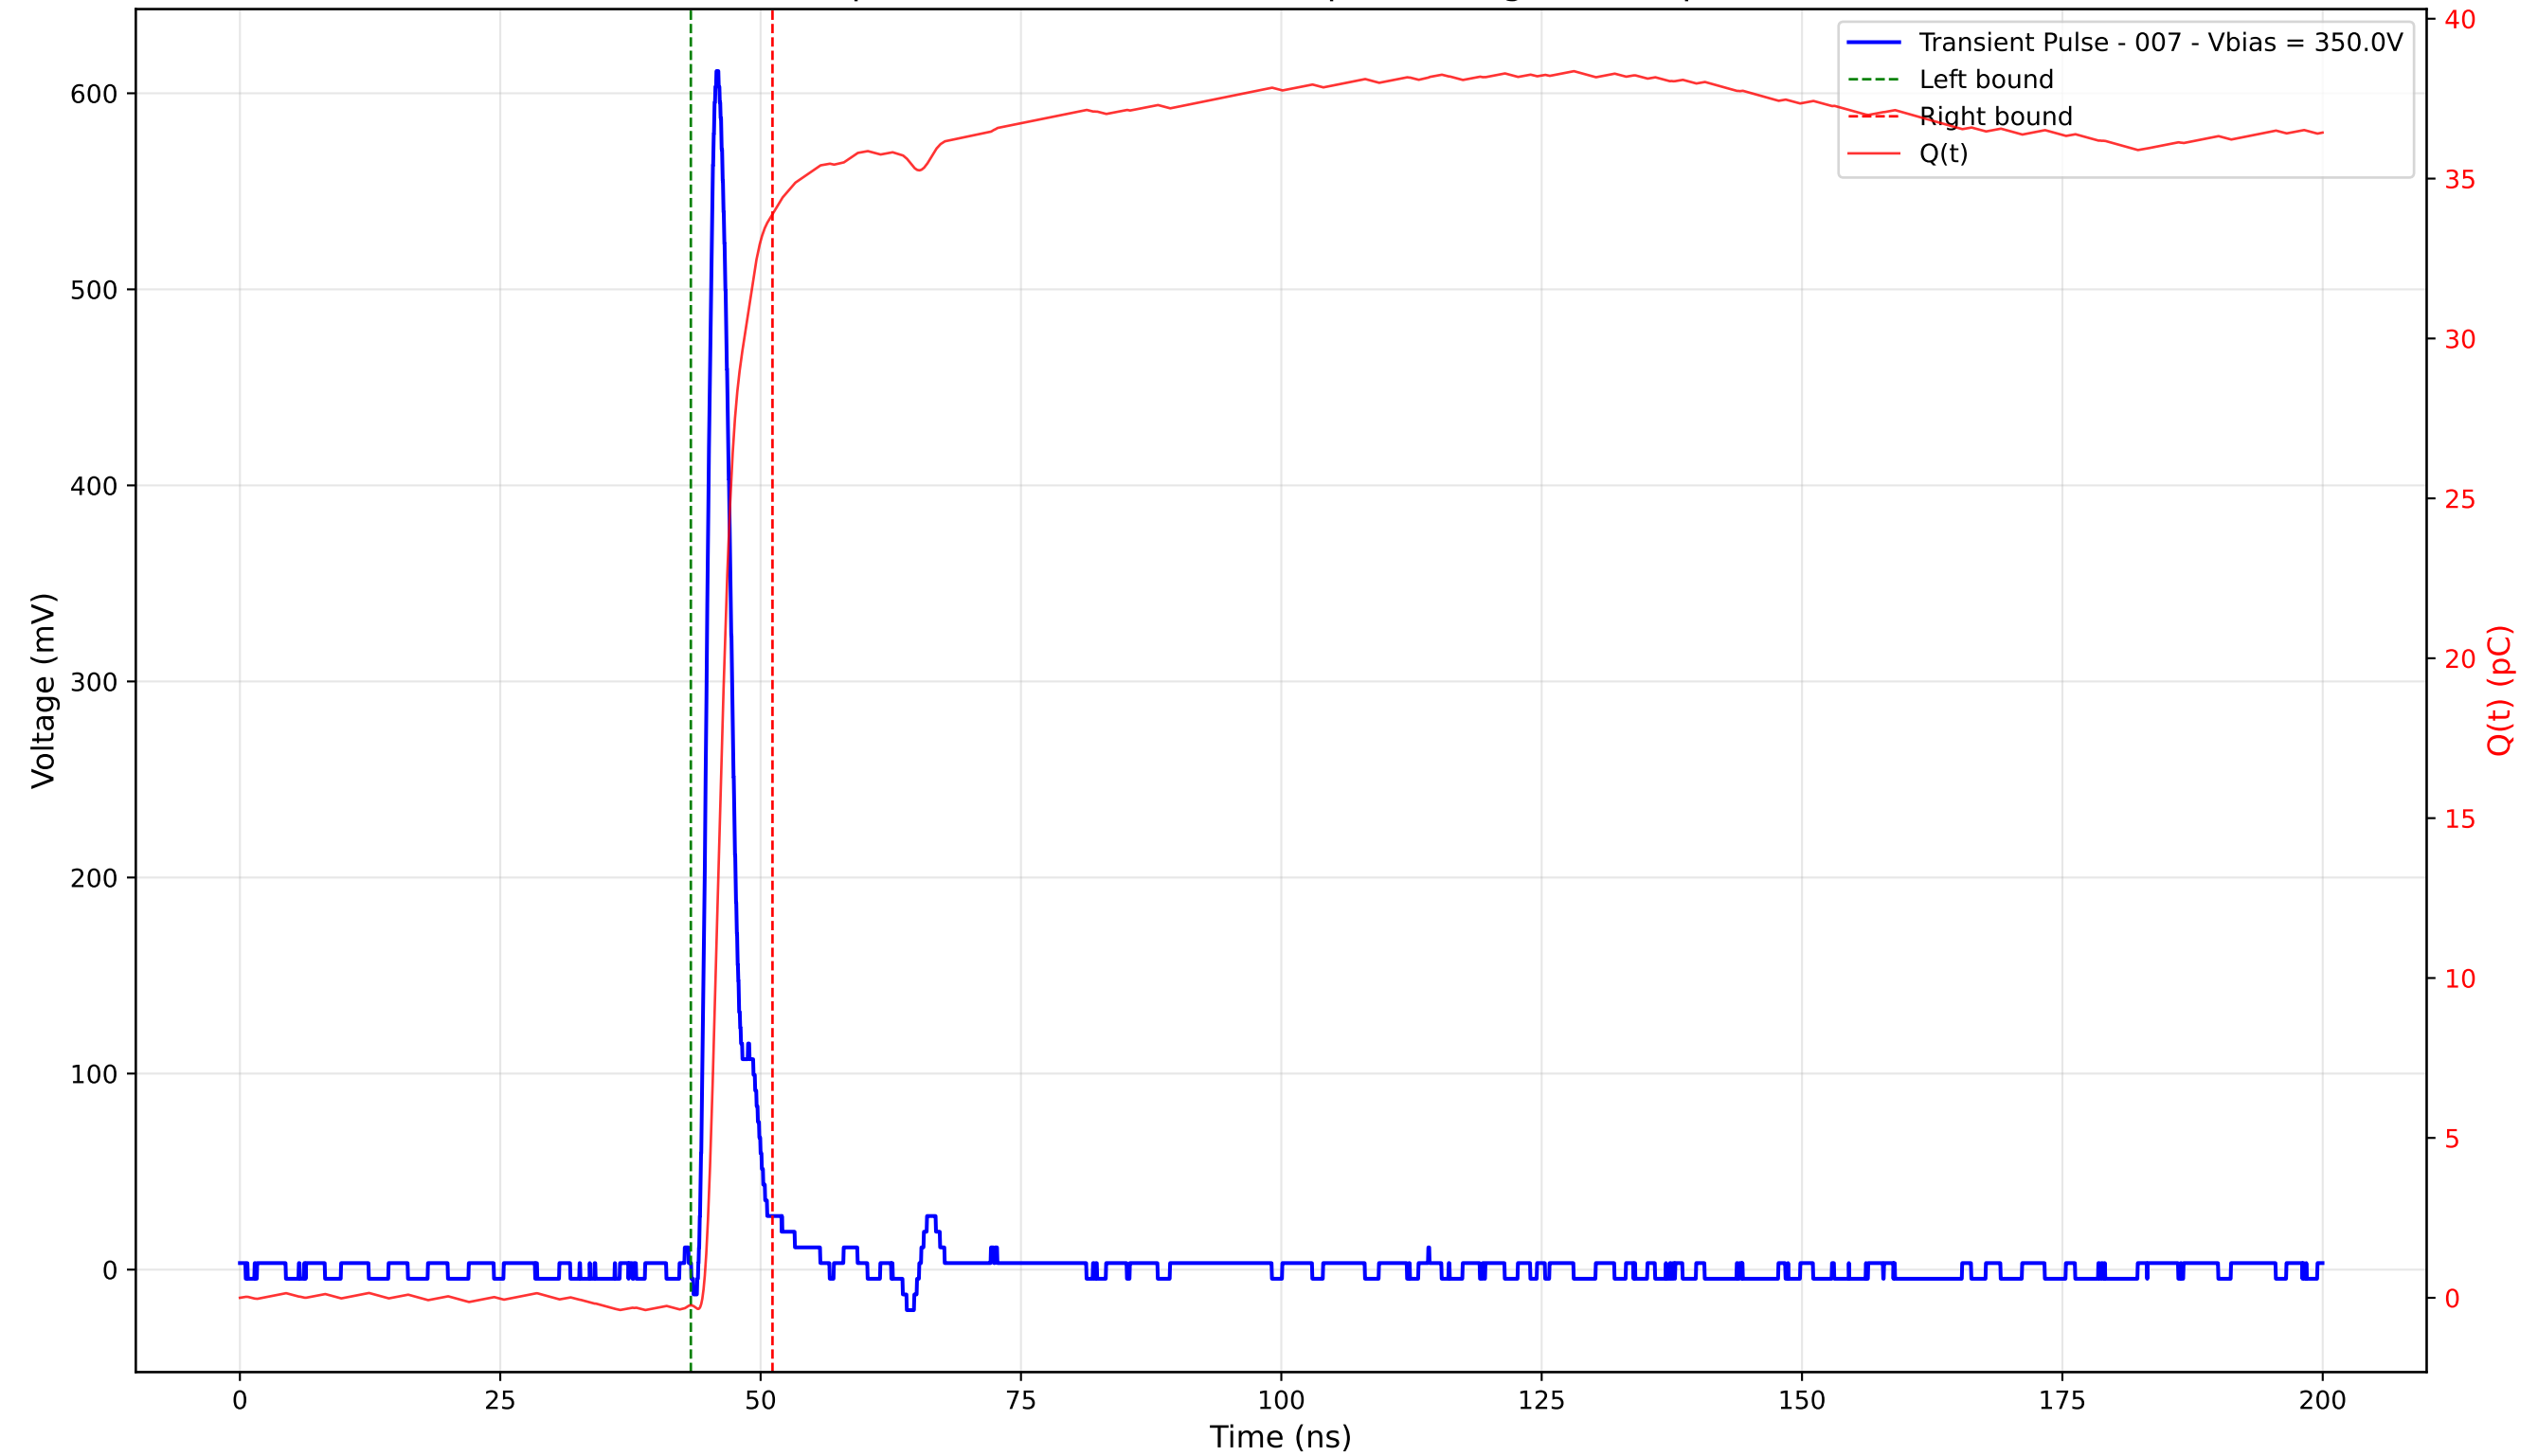


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 34.24 pC - Rise Time: 1.10 ns

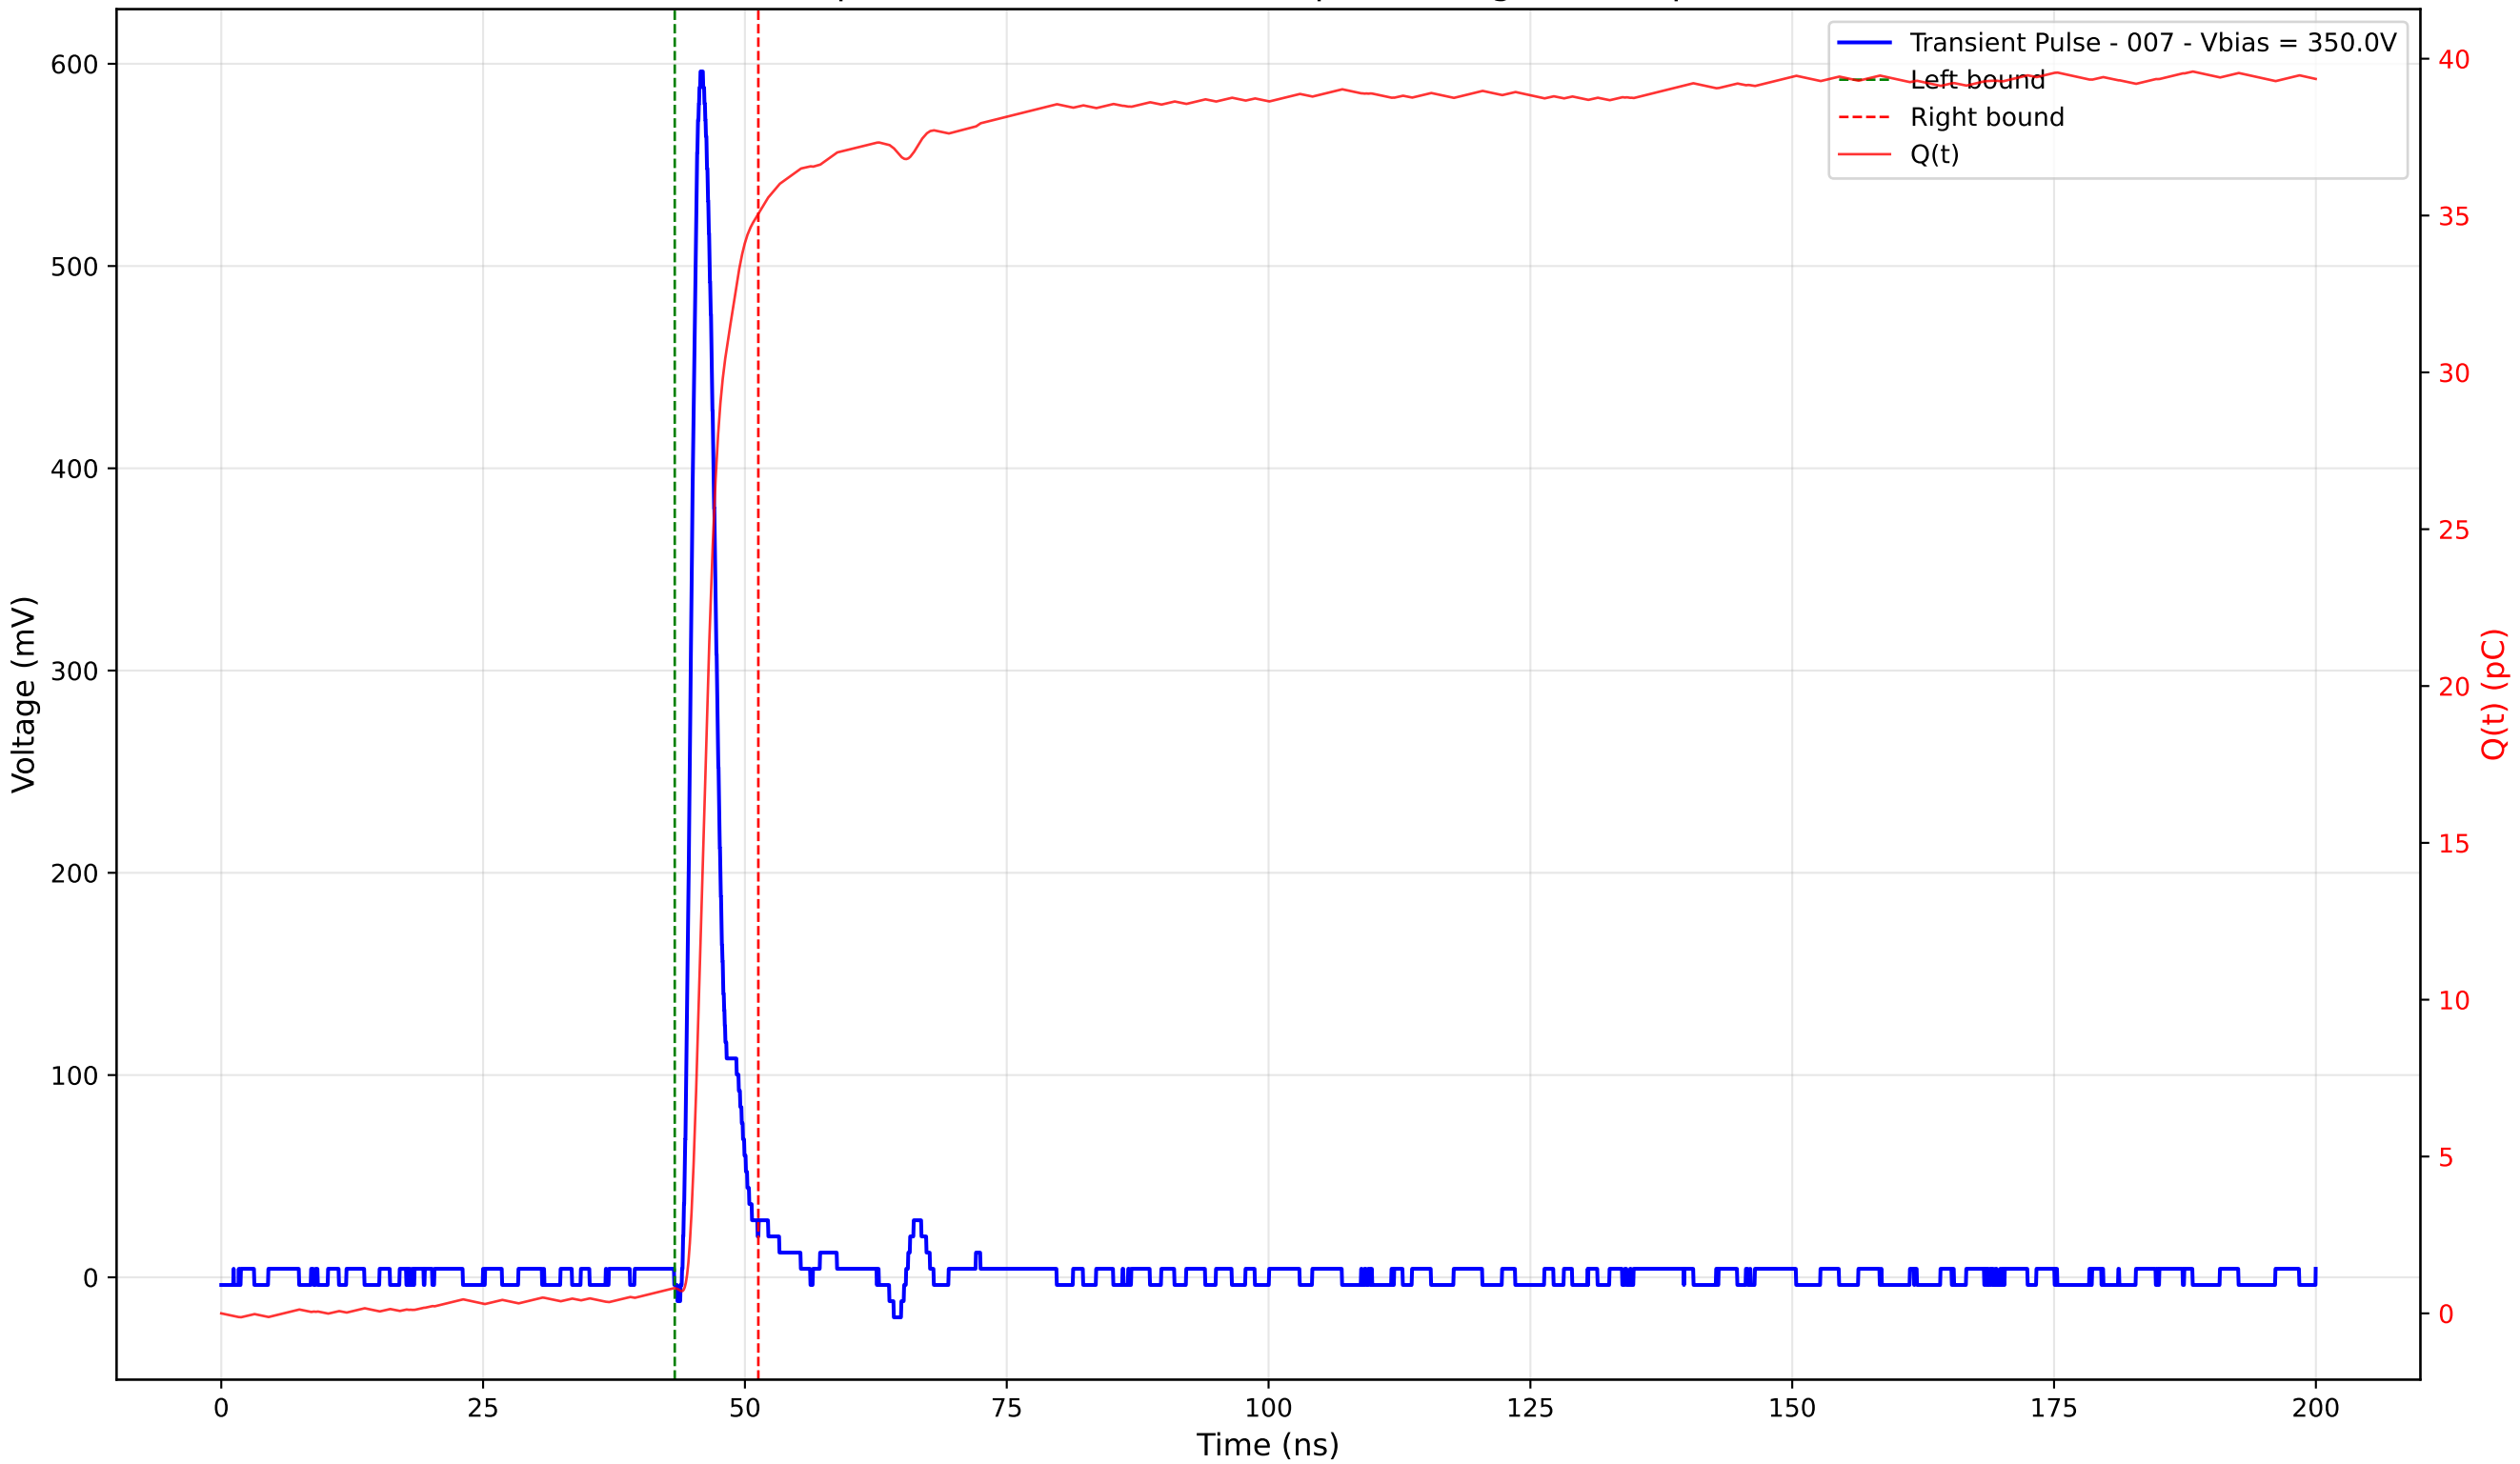


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 33.89 pC - Rise Time: 1.10 ns

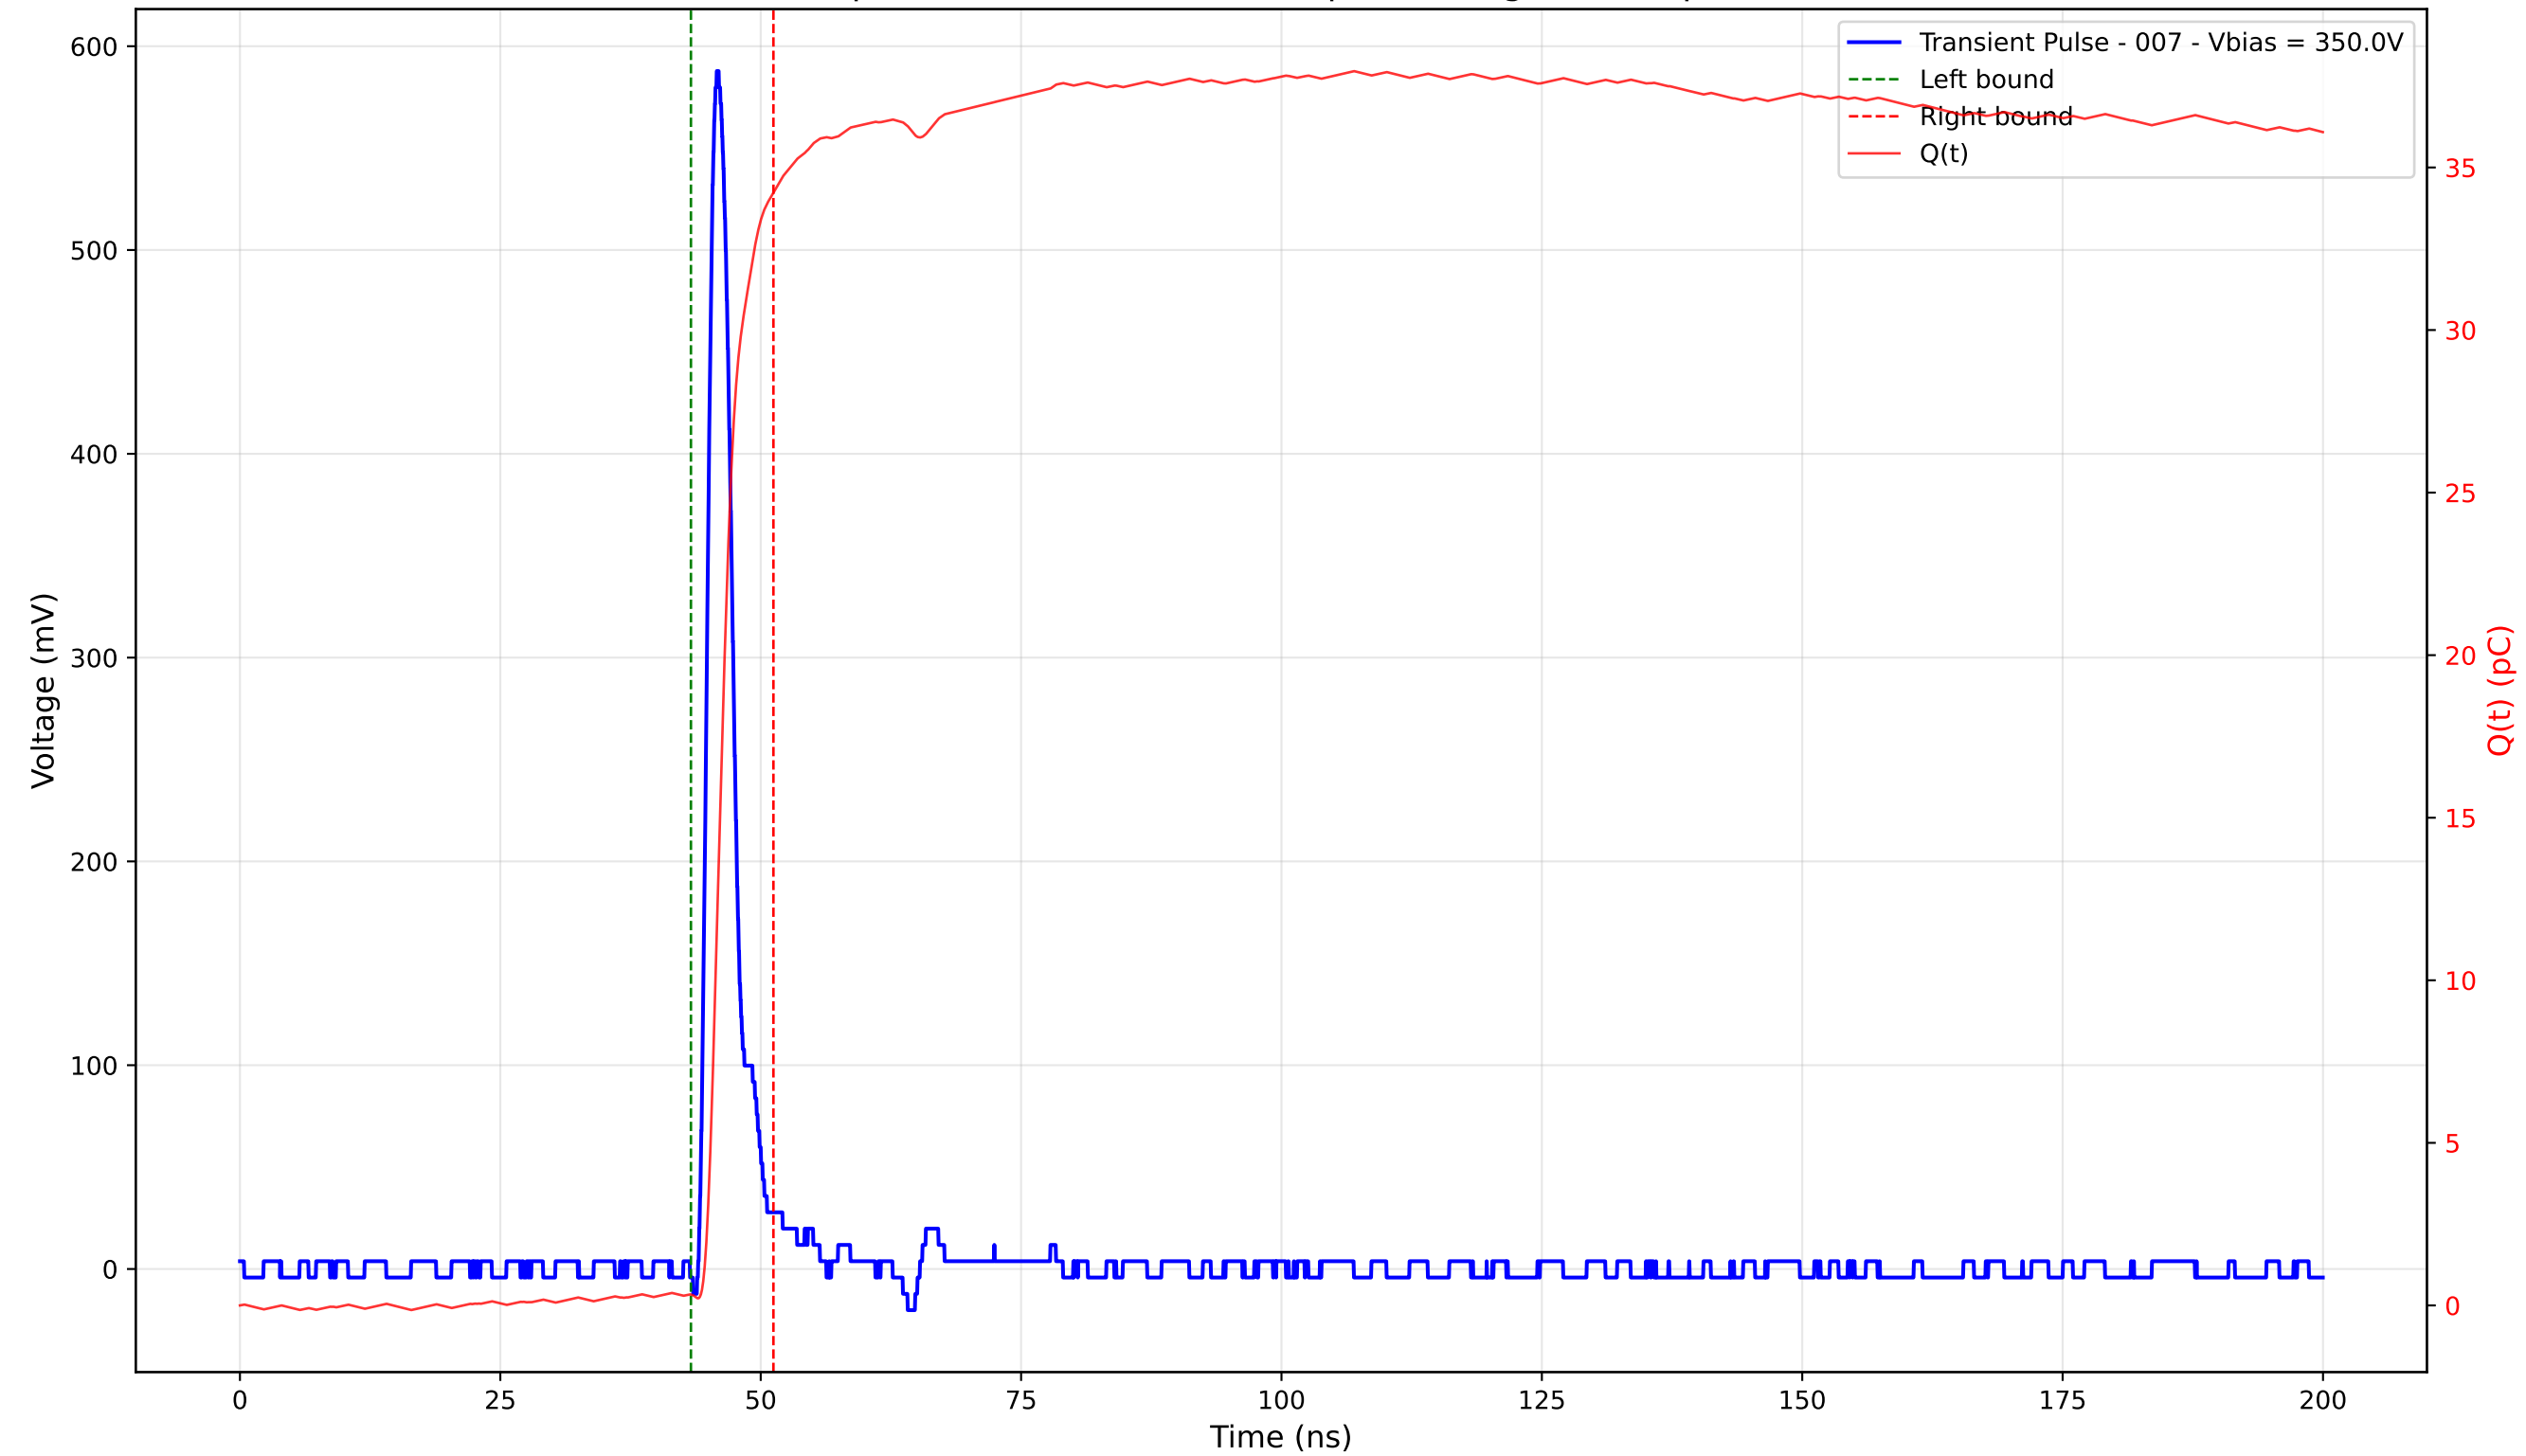


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 33.59 pC - Rise Time: 1.08 ns

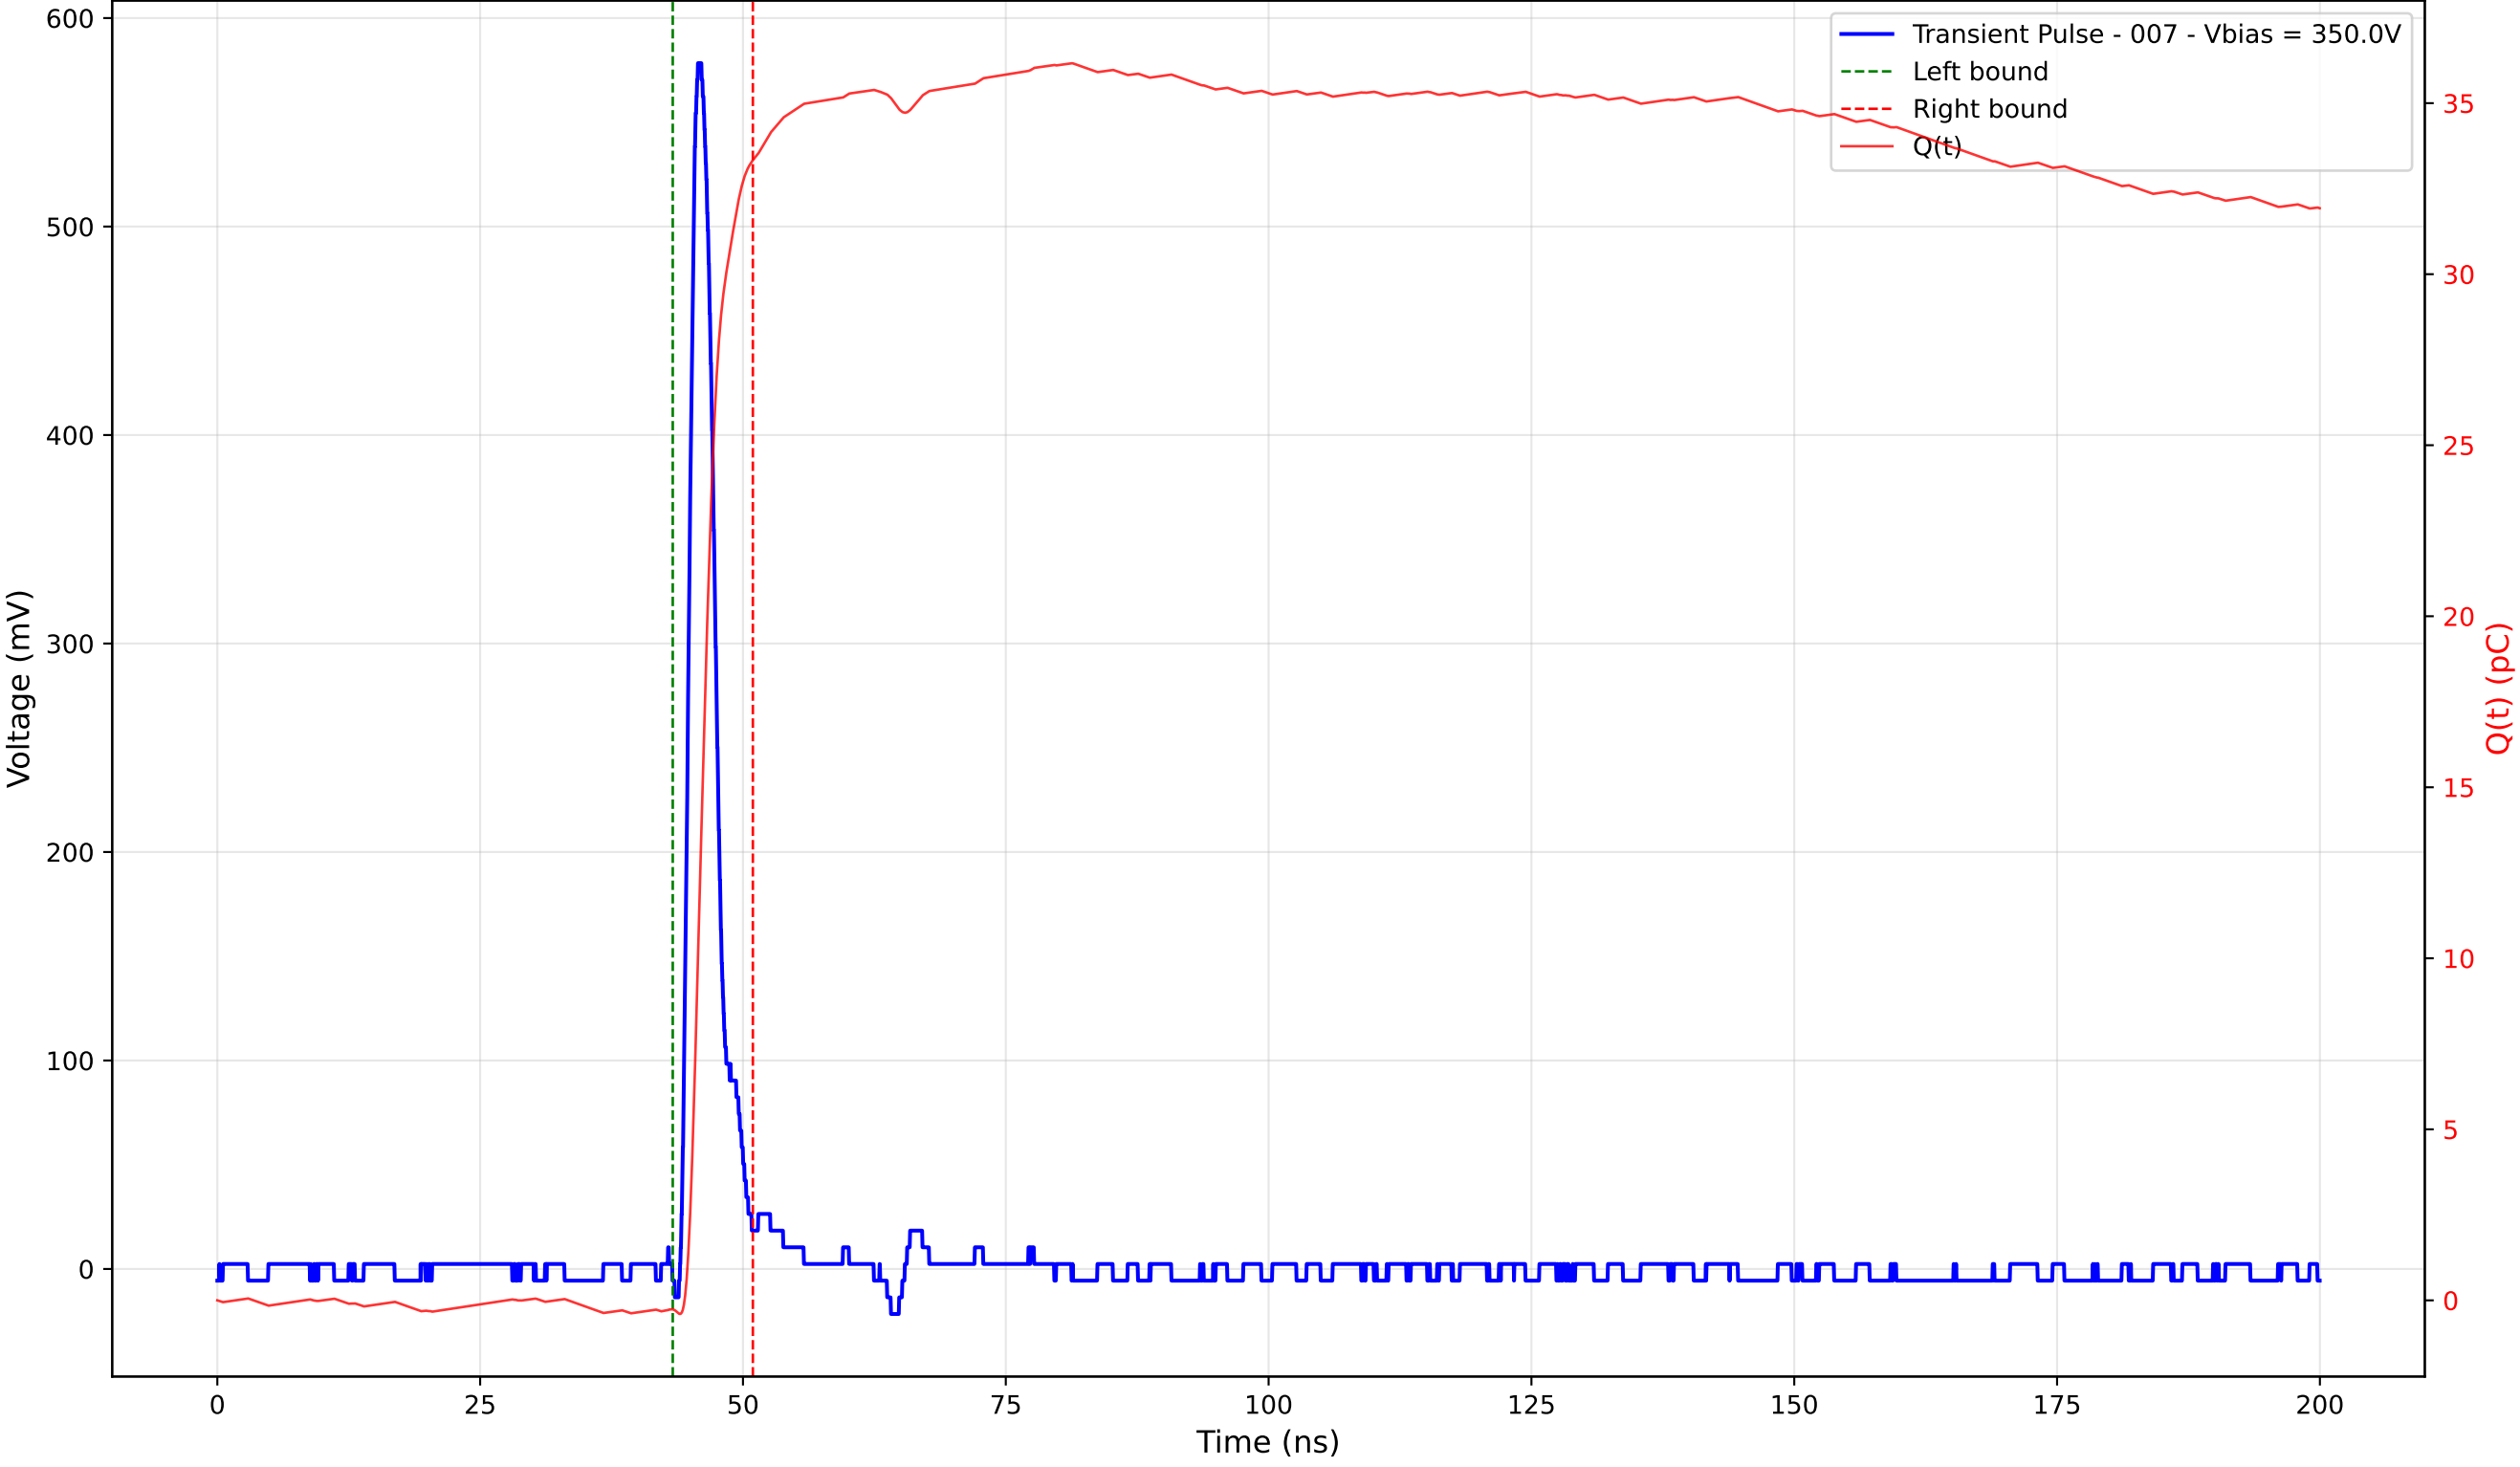


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 32.93 pC - Rise Time: 1.06 ns

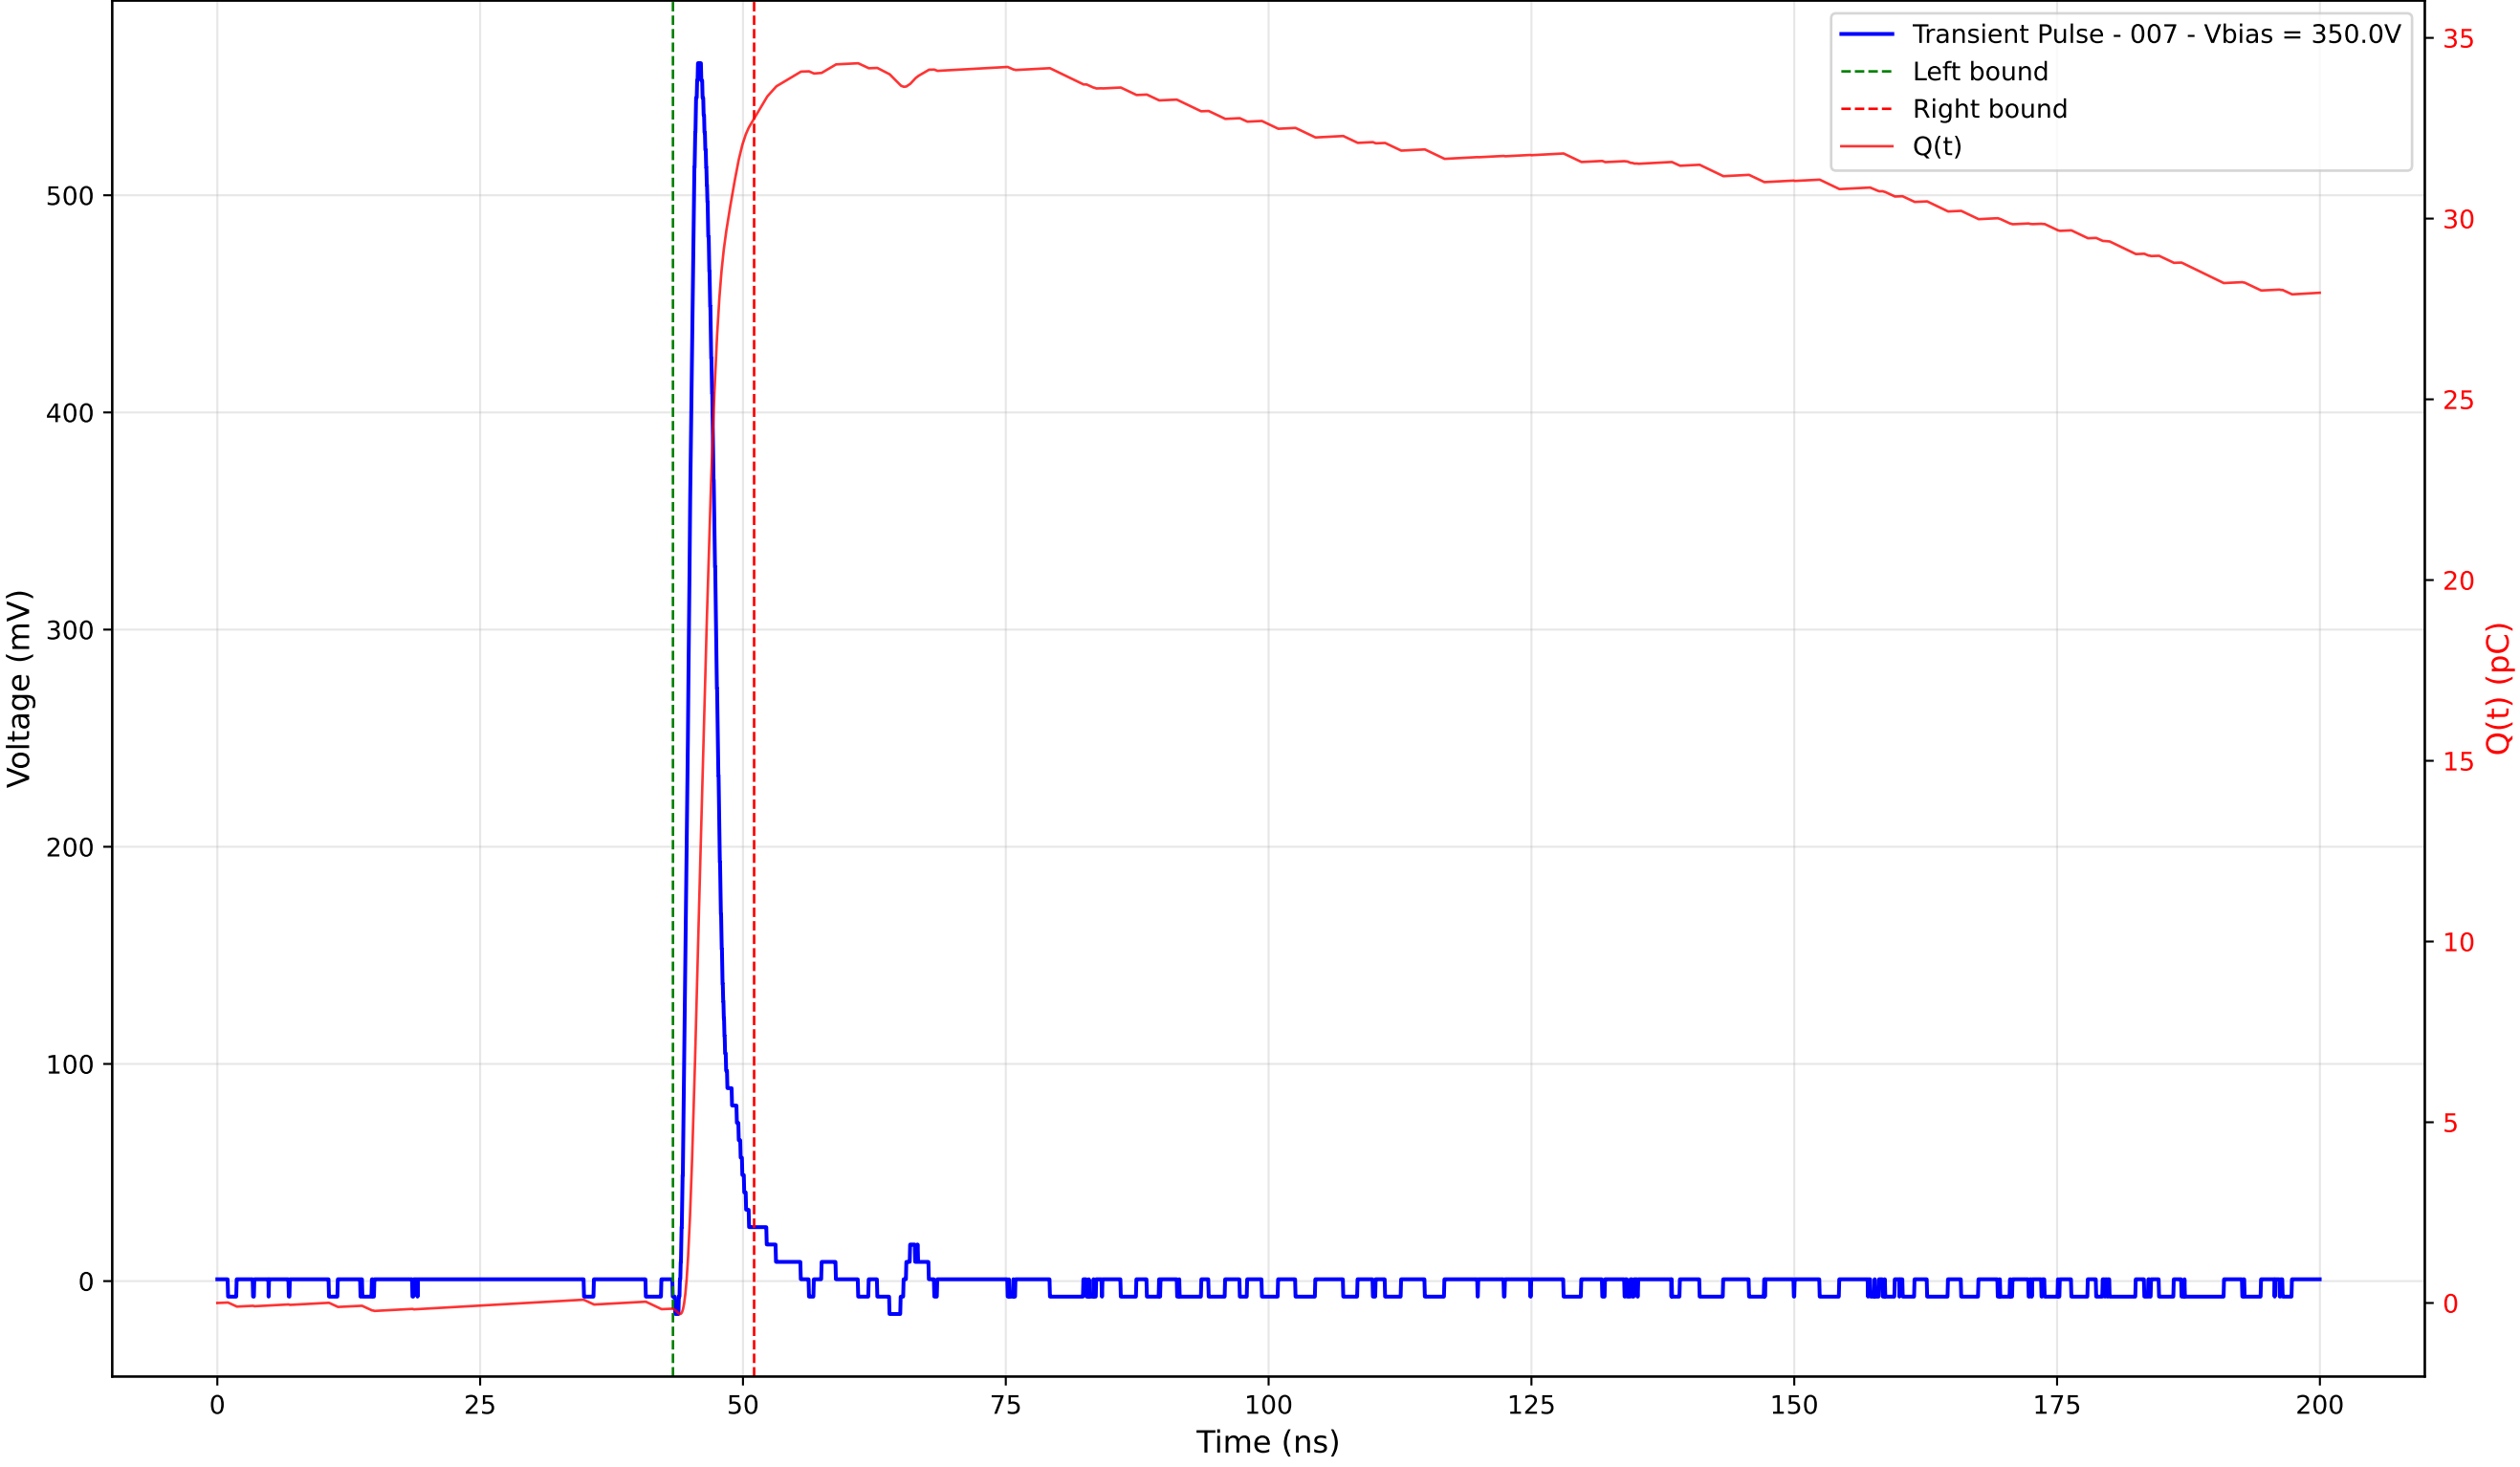


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 32.89 pC - Rise Time: 1.07 ns

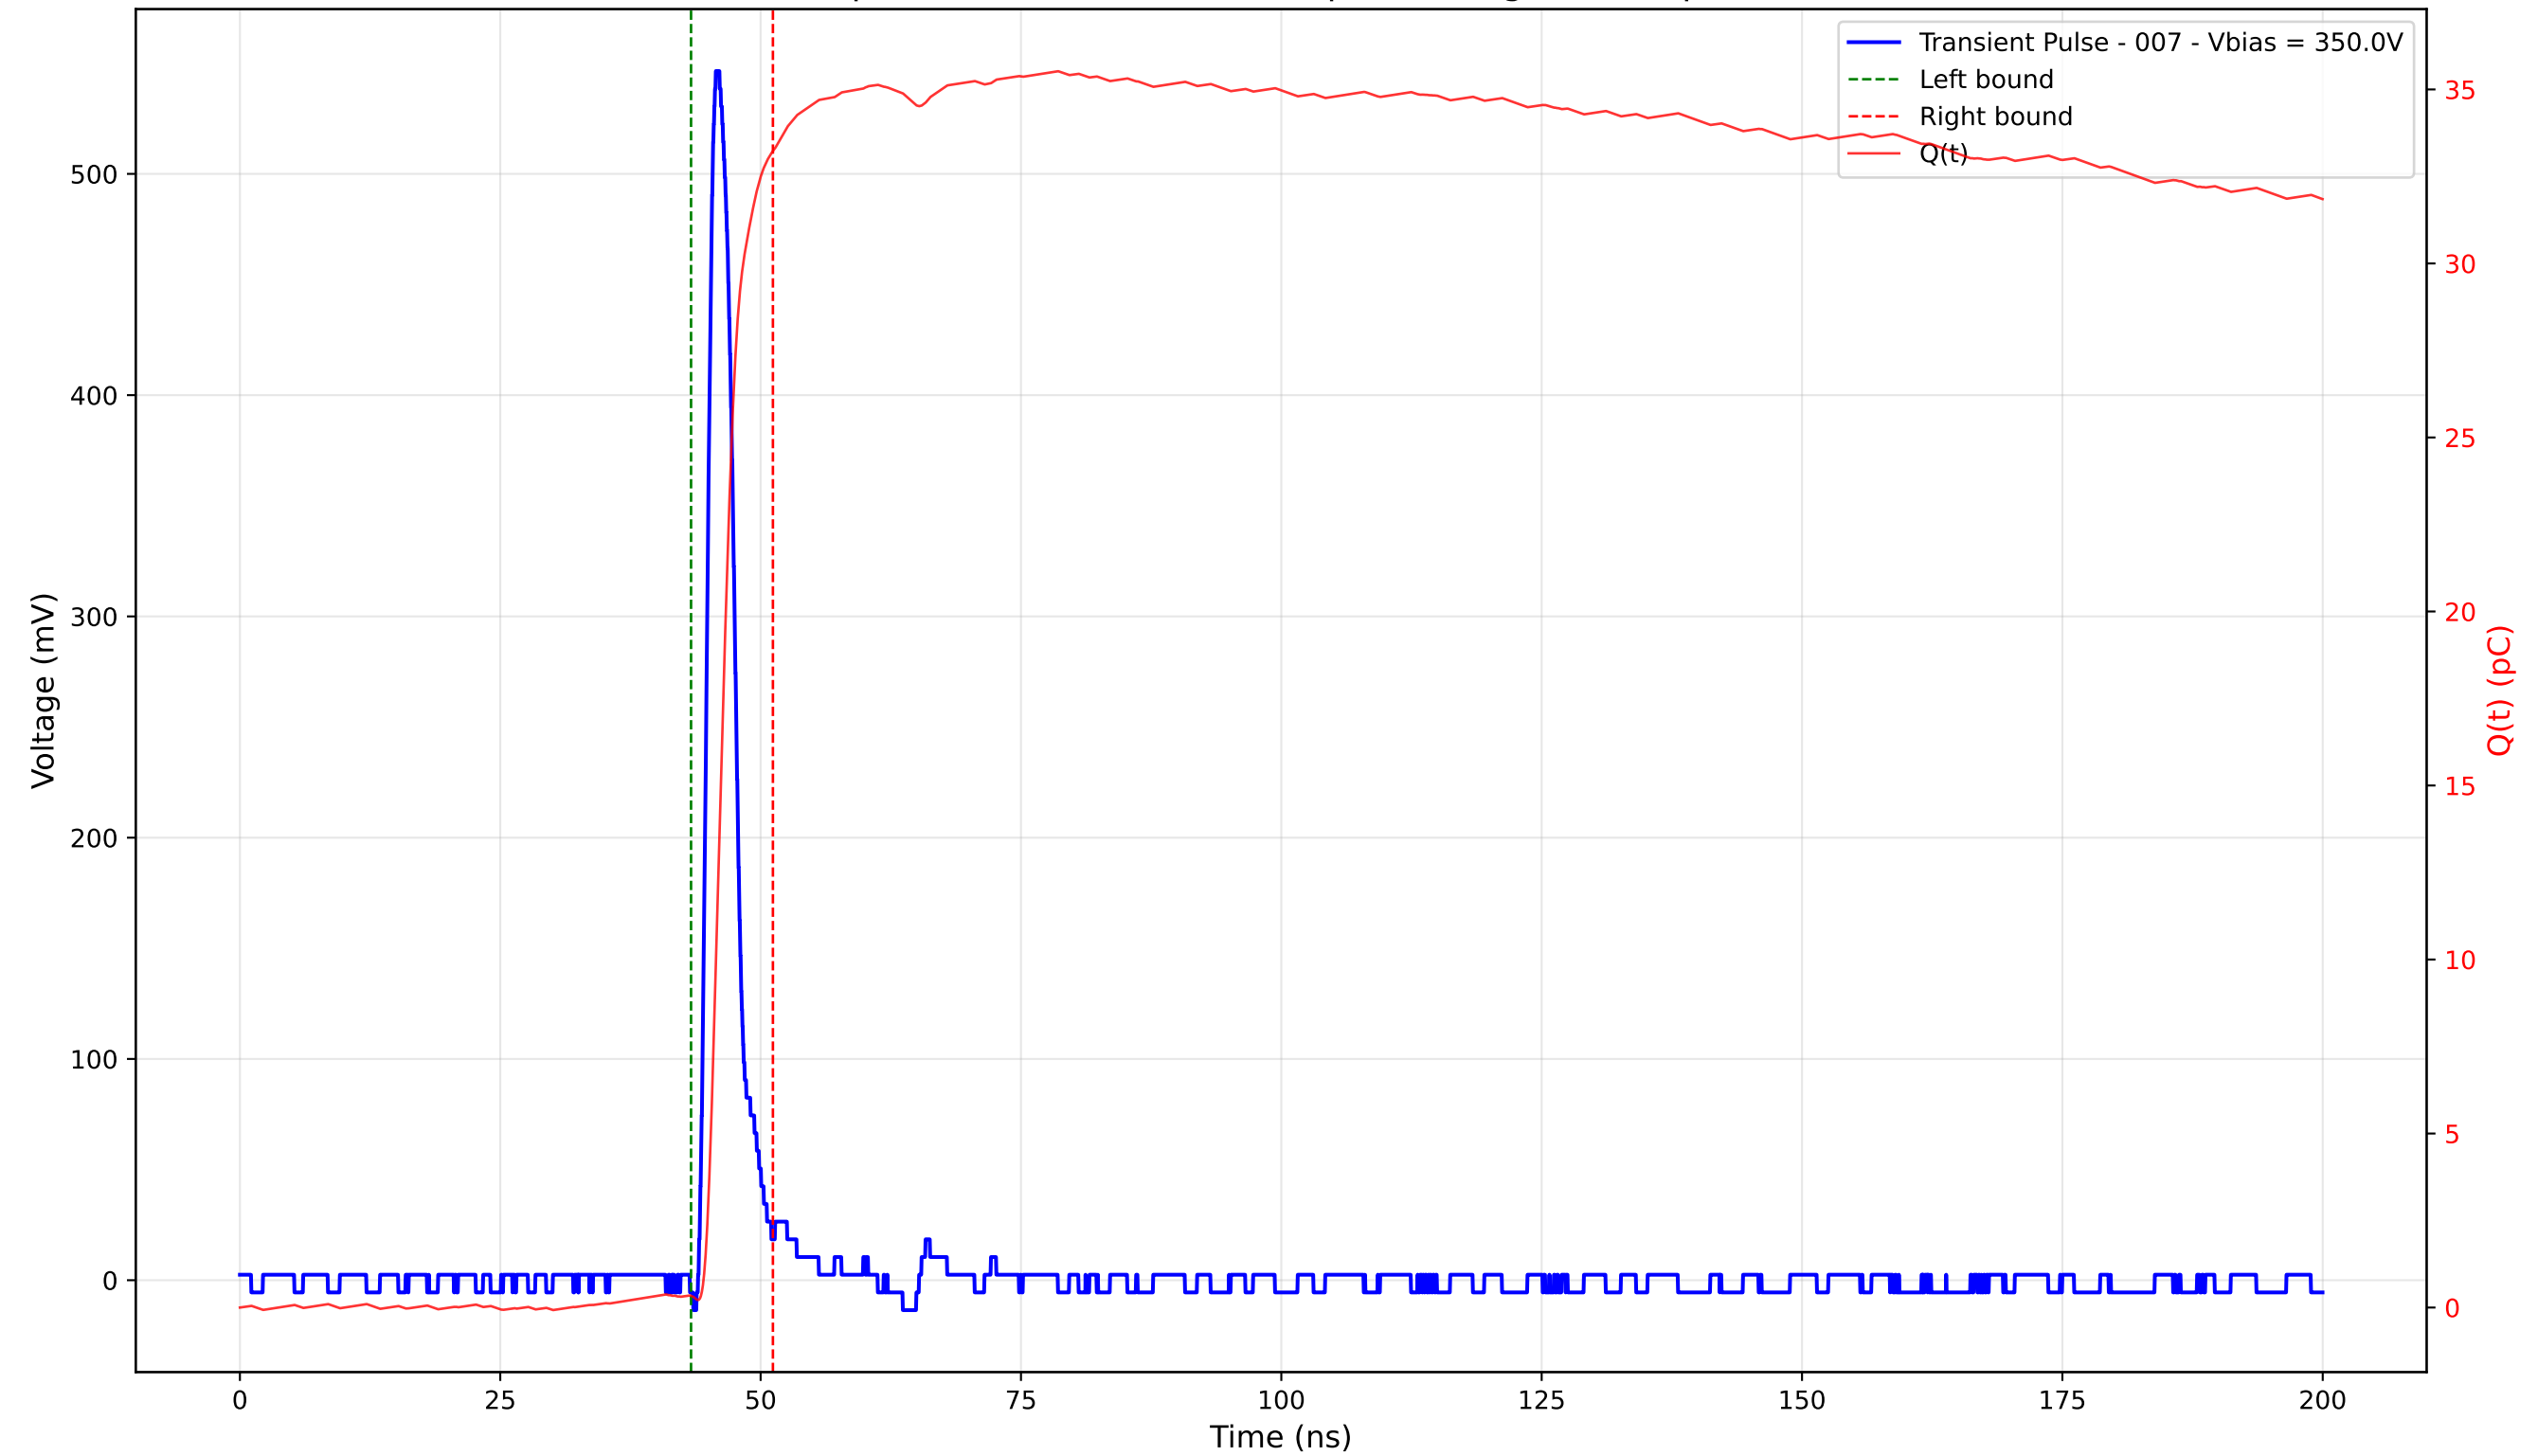


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 32.82 pC - Rise Time: 1.11 ns

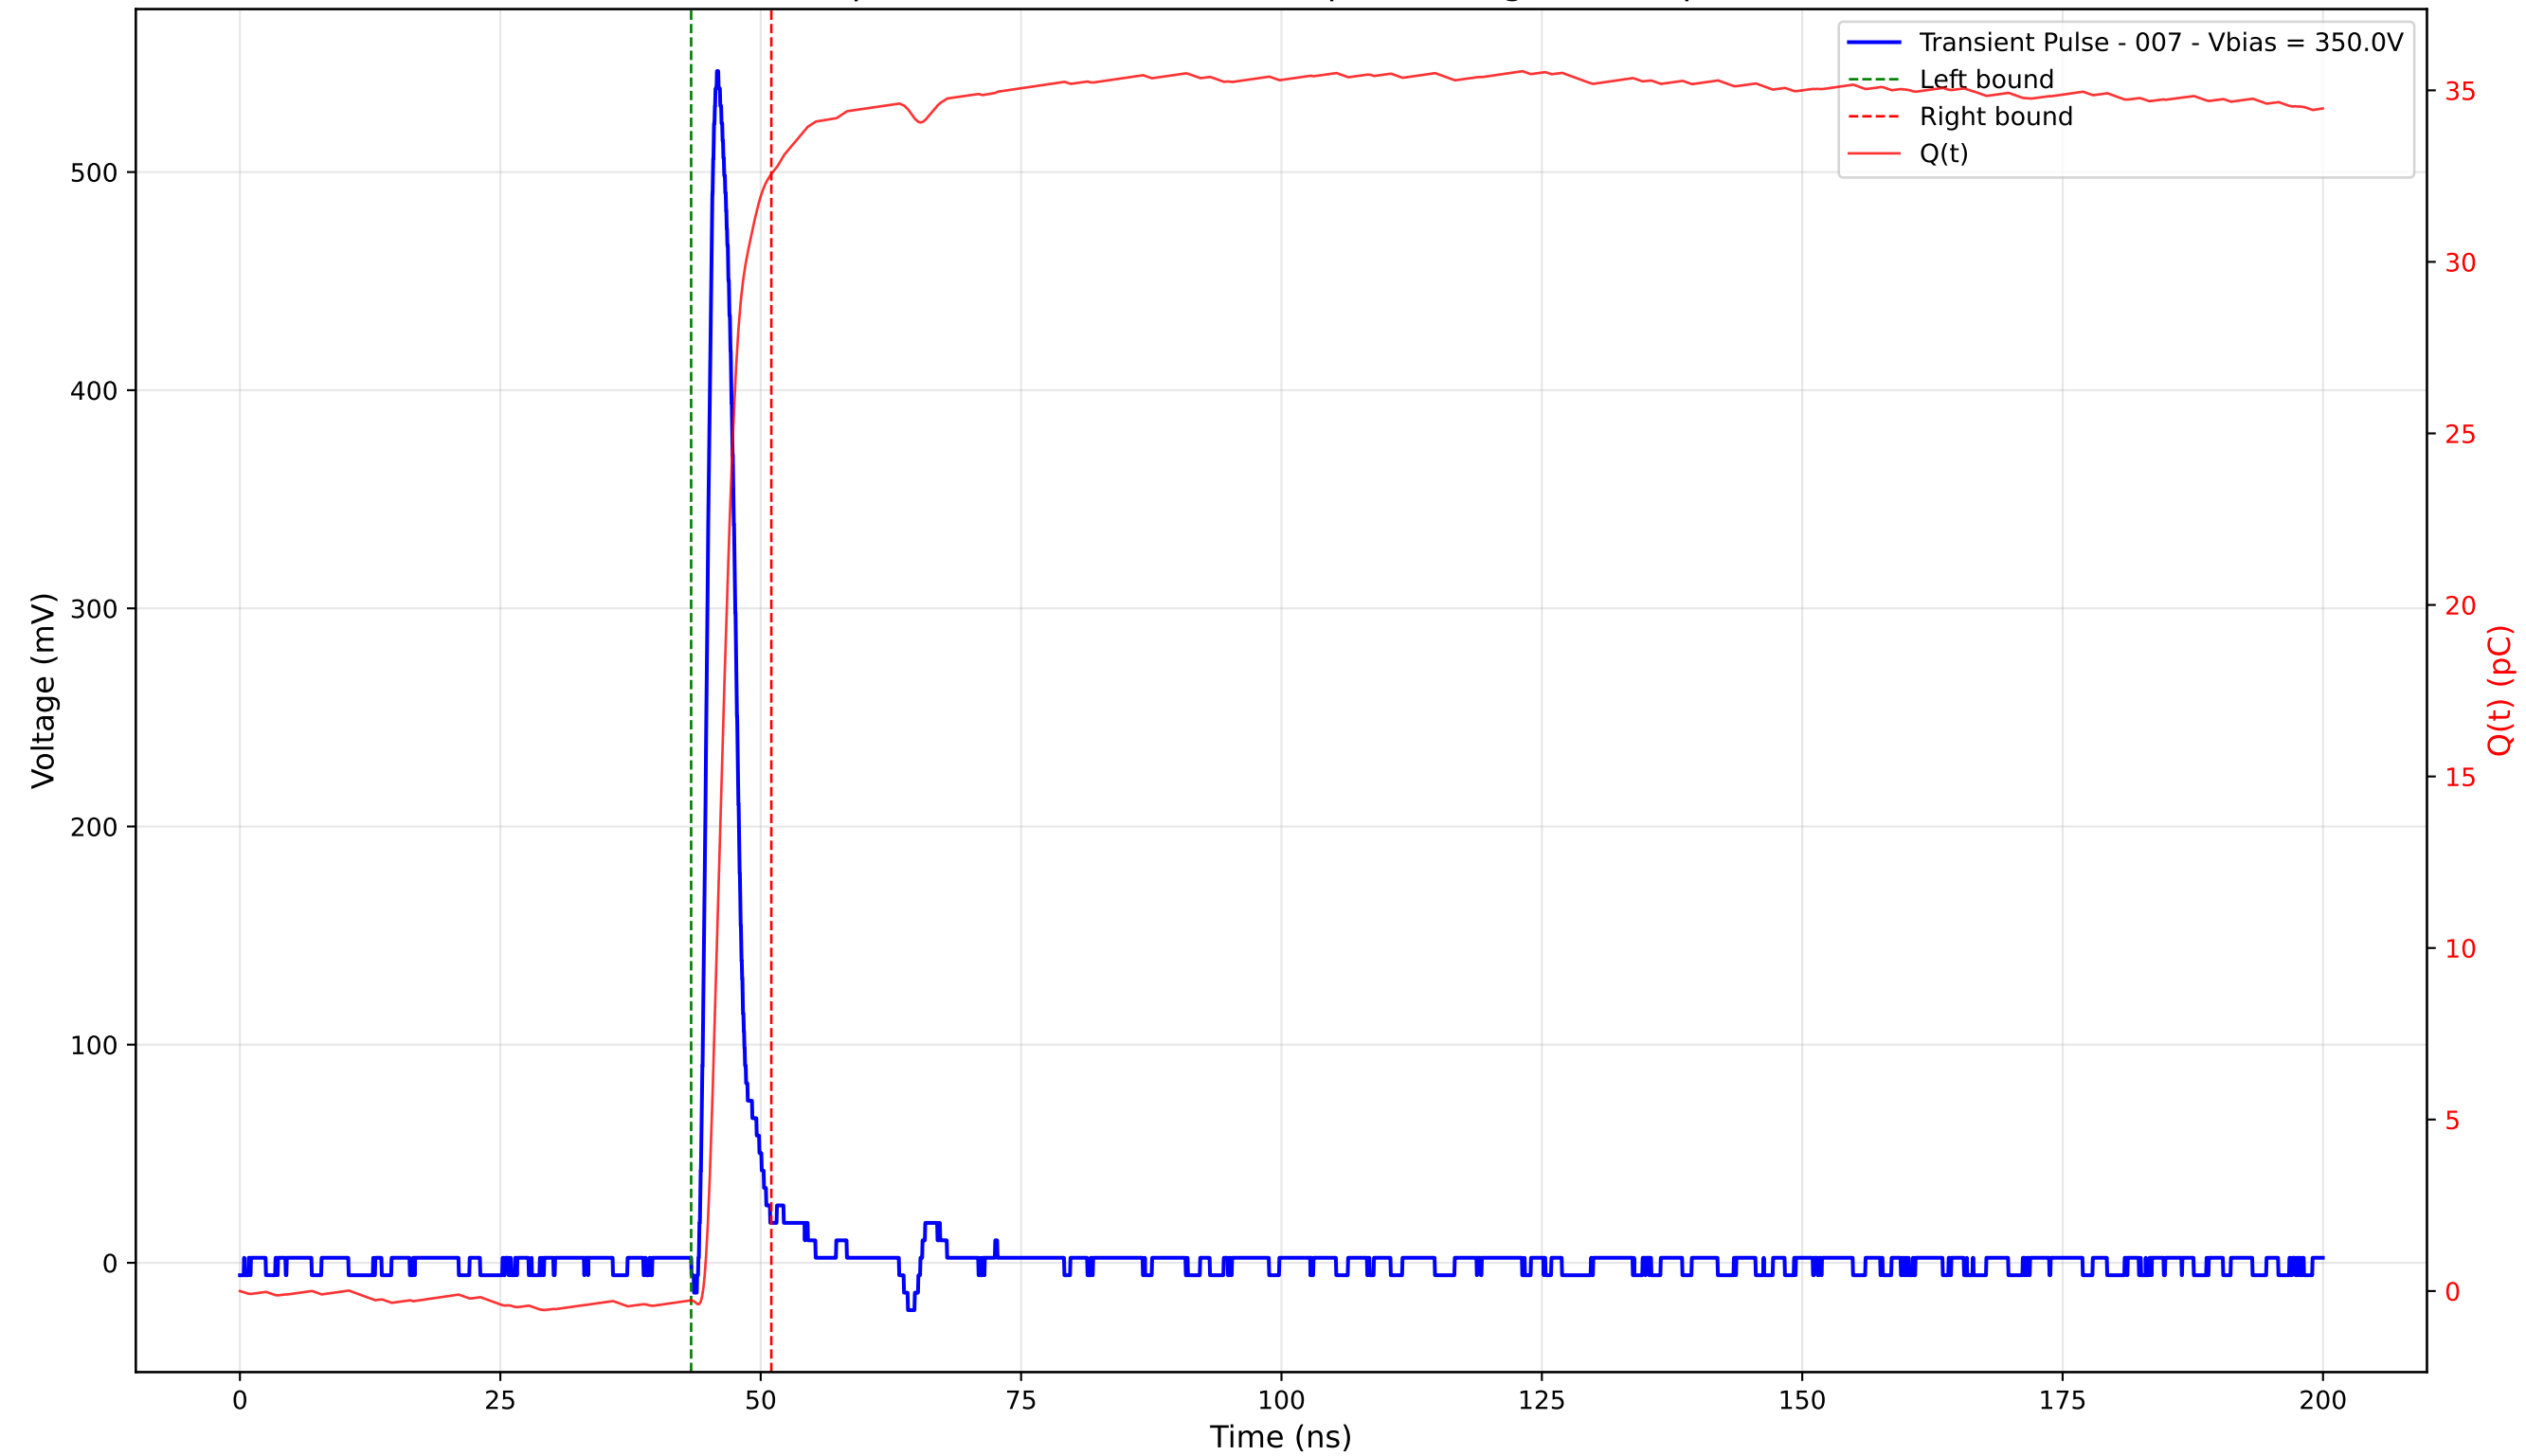


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 33.11 pC - Rise Time: 1.07 ns

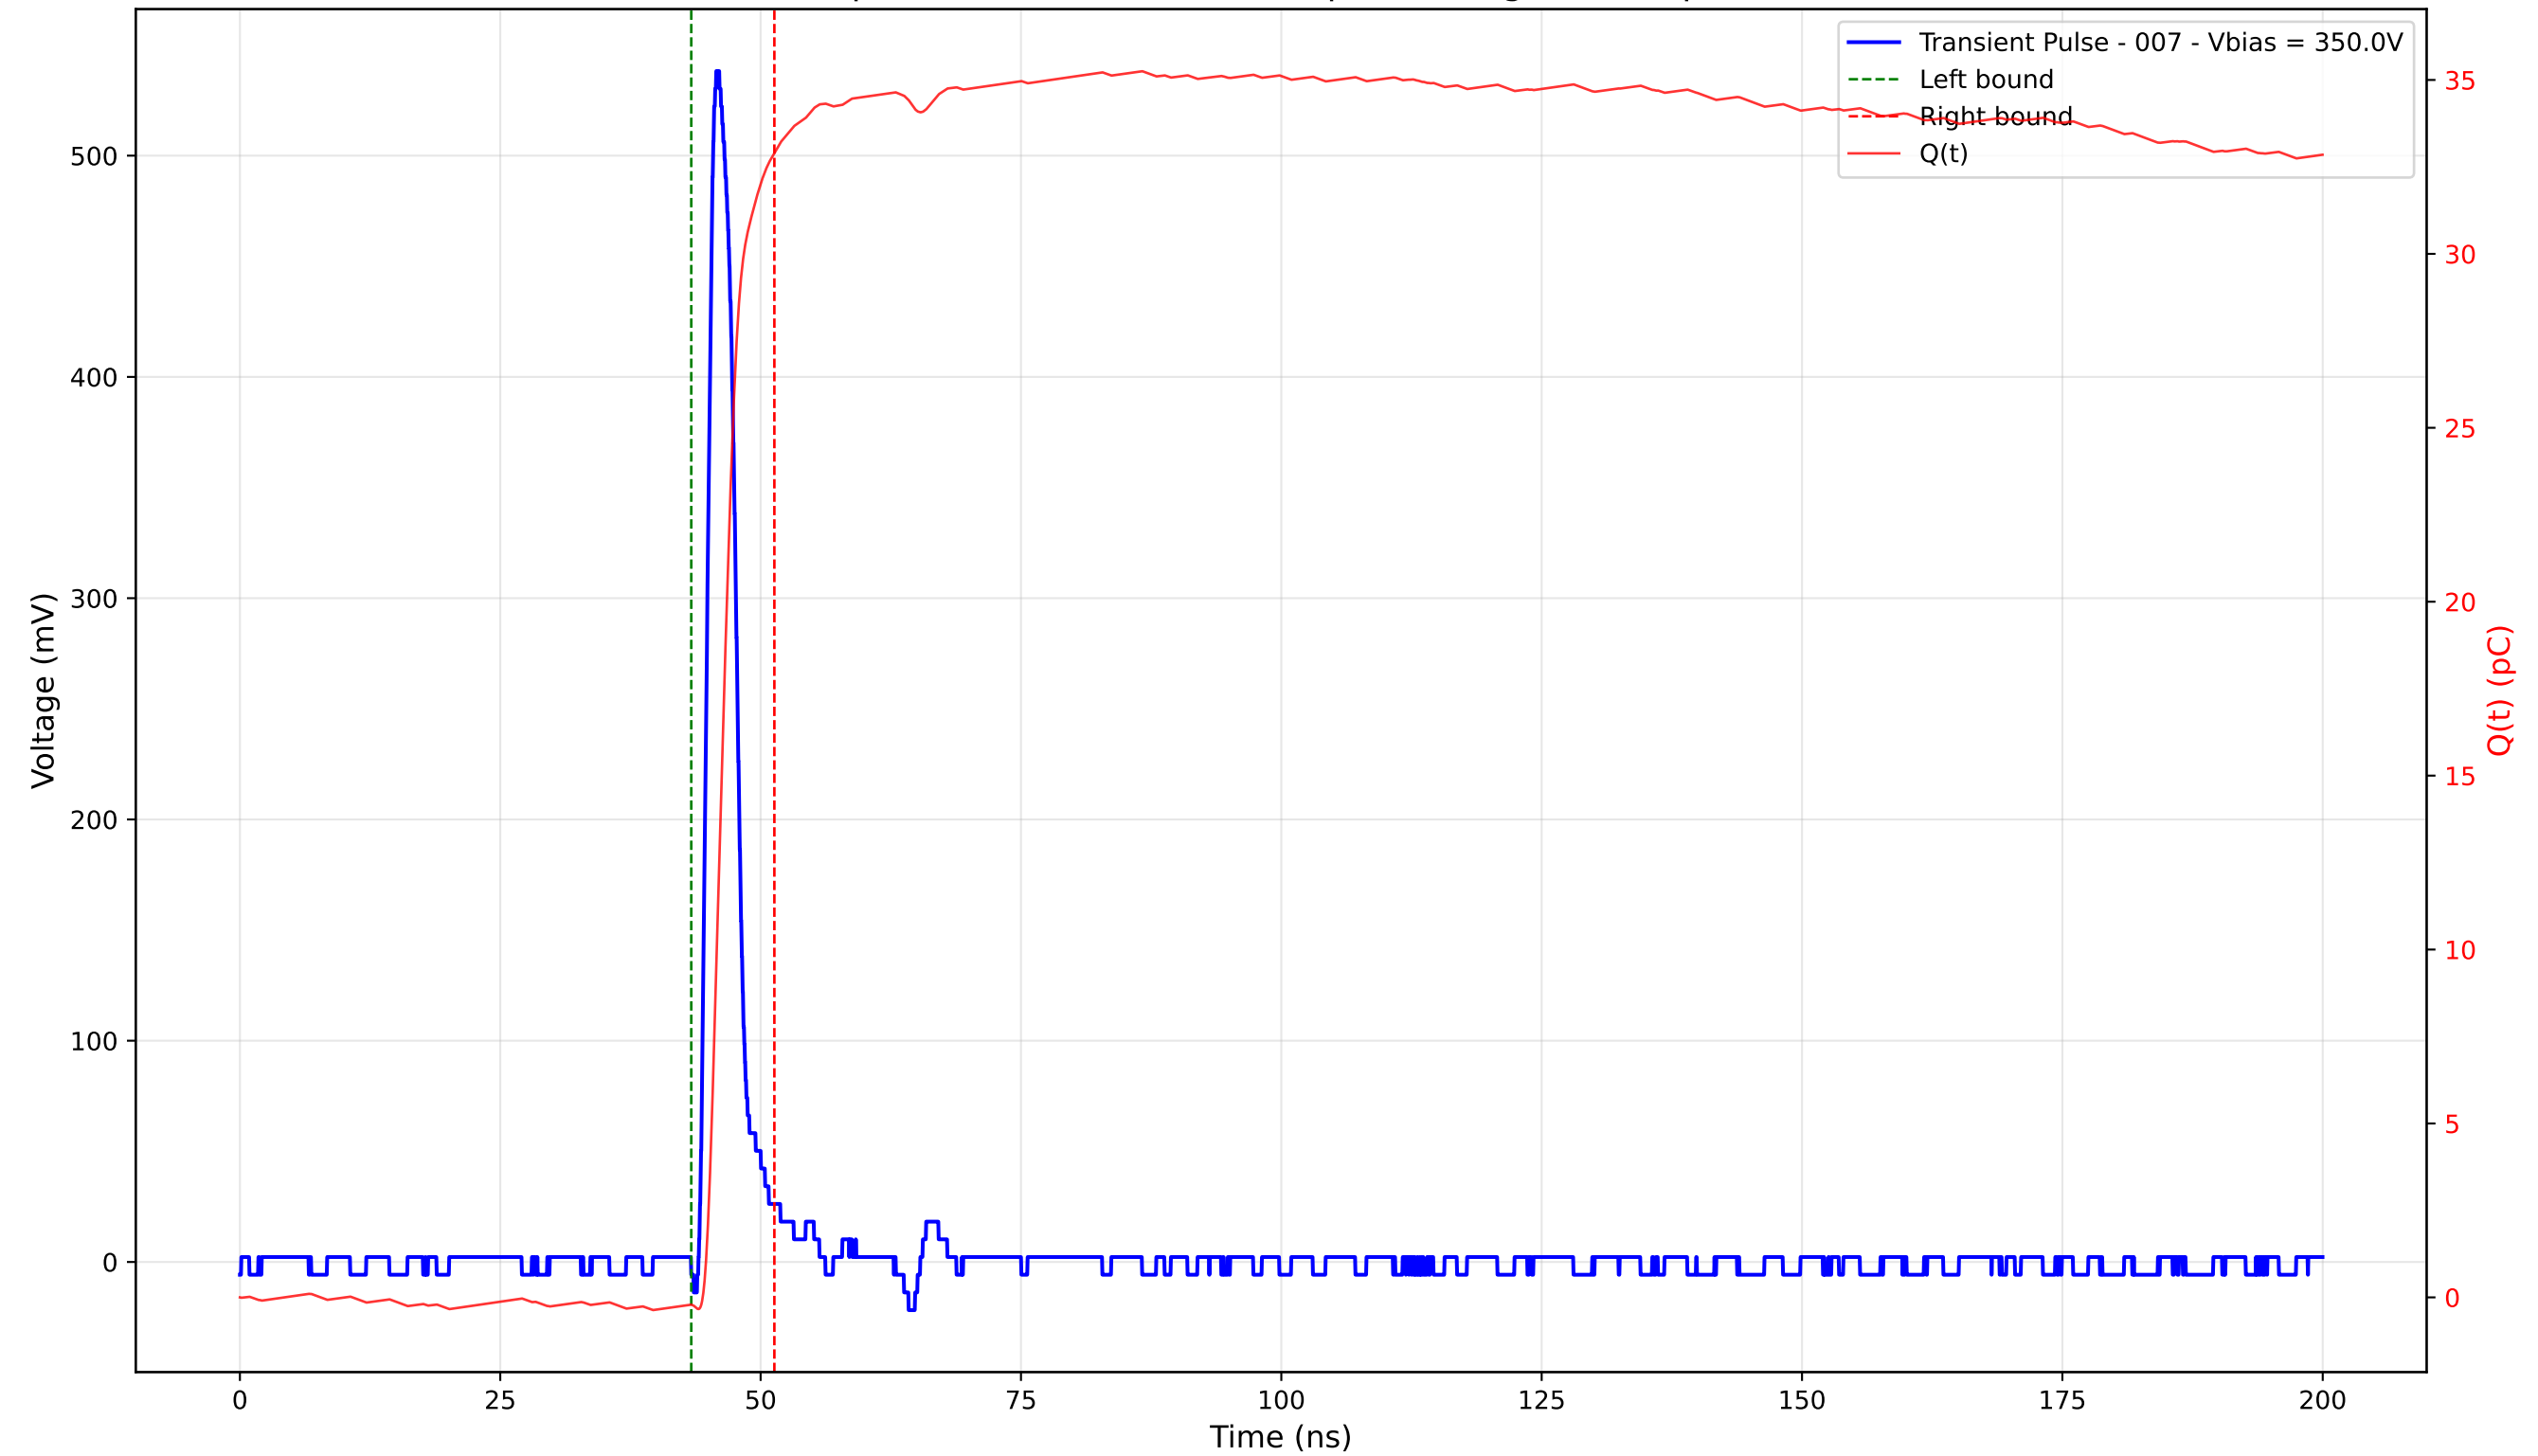


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 32.69 pC - Rise Time: 1.09 ns

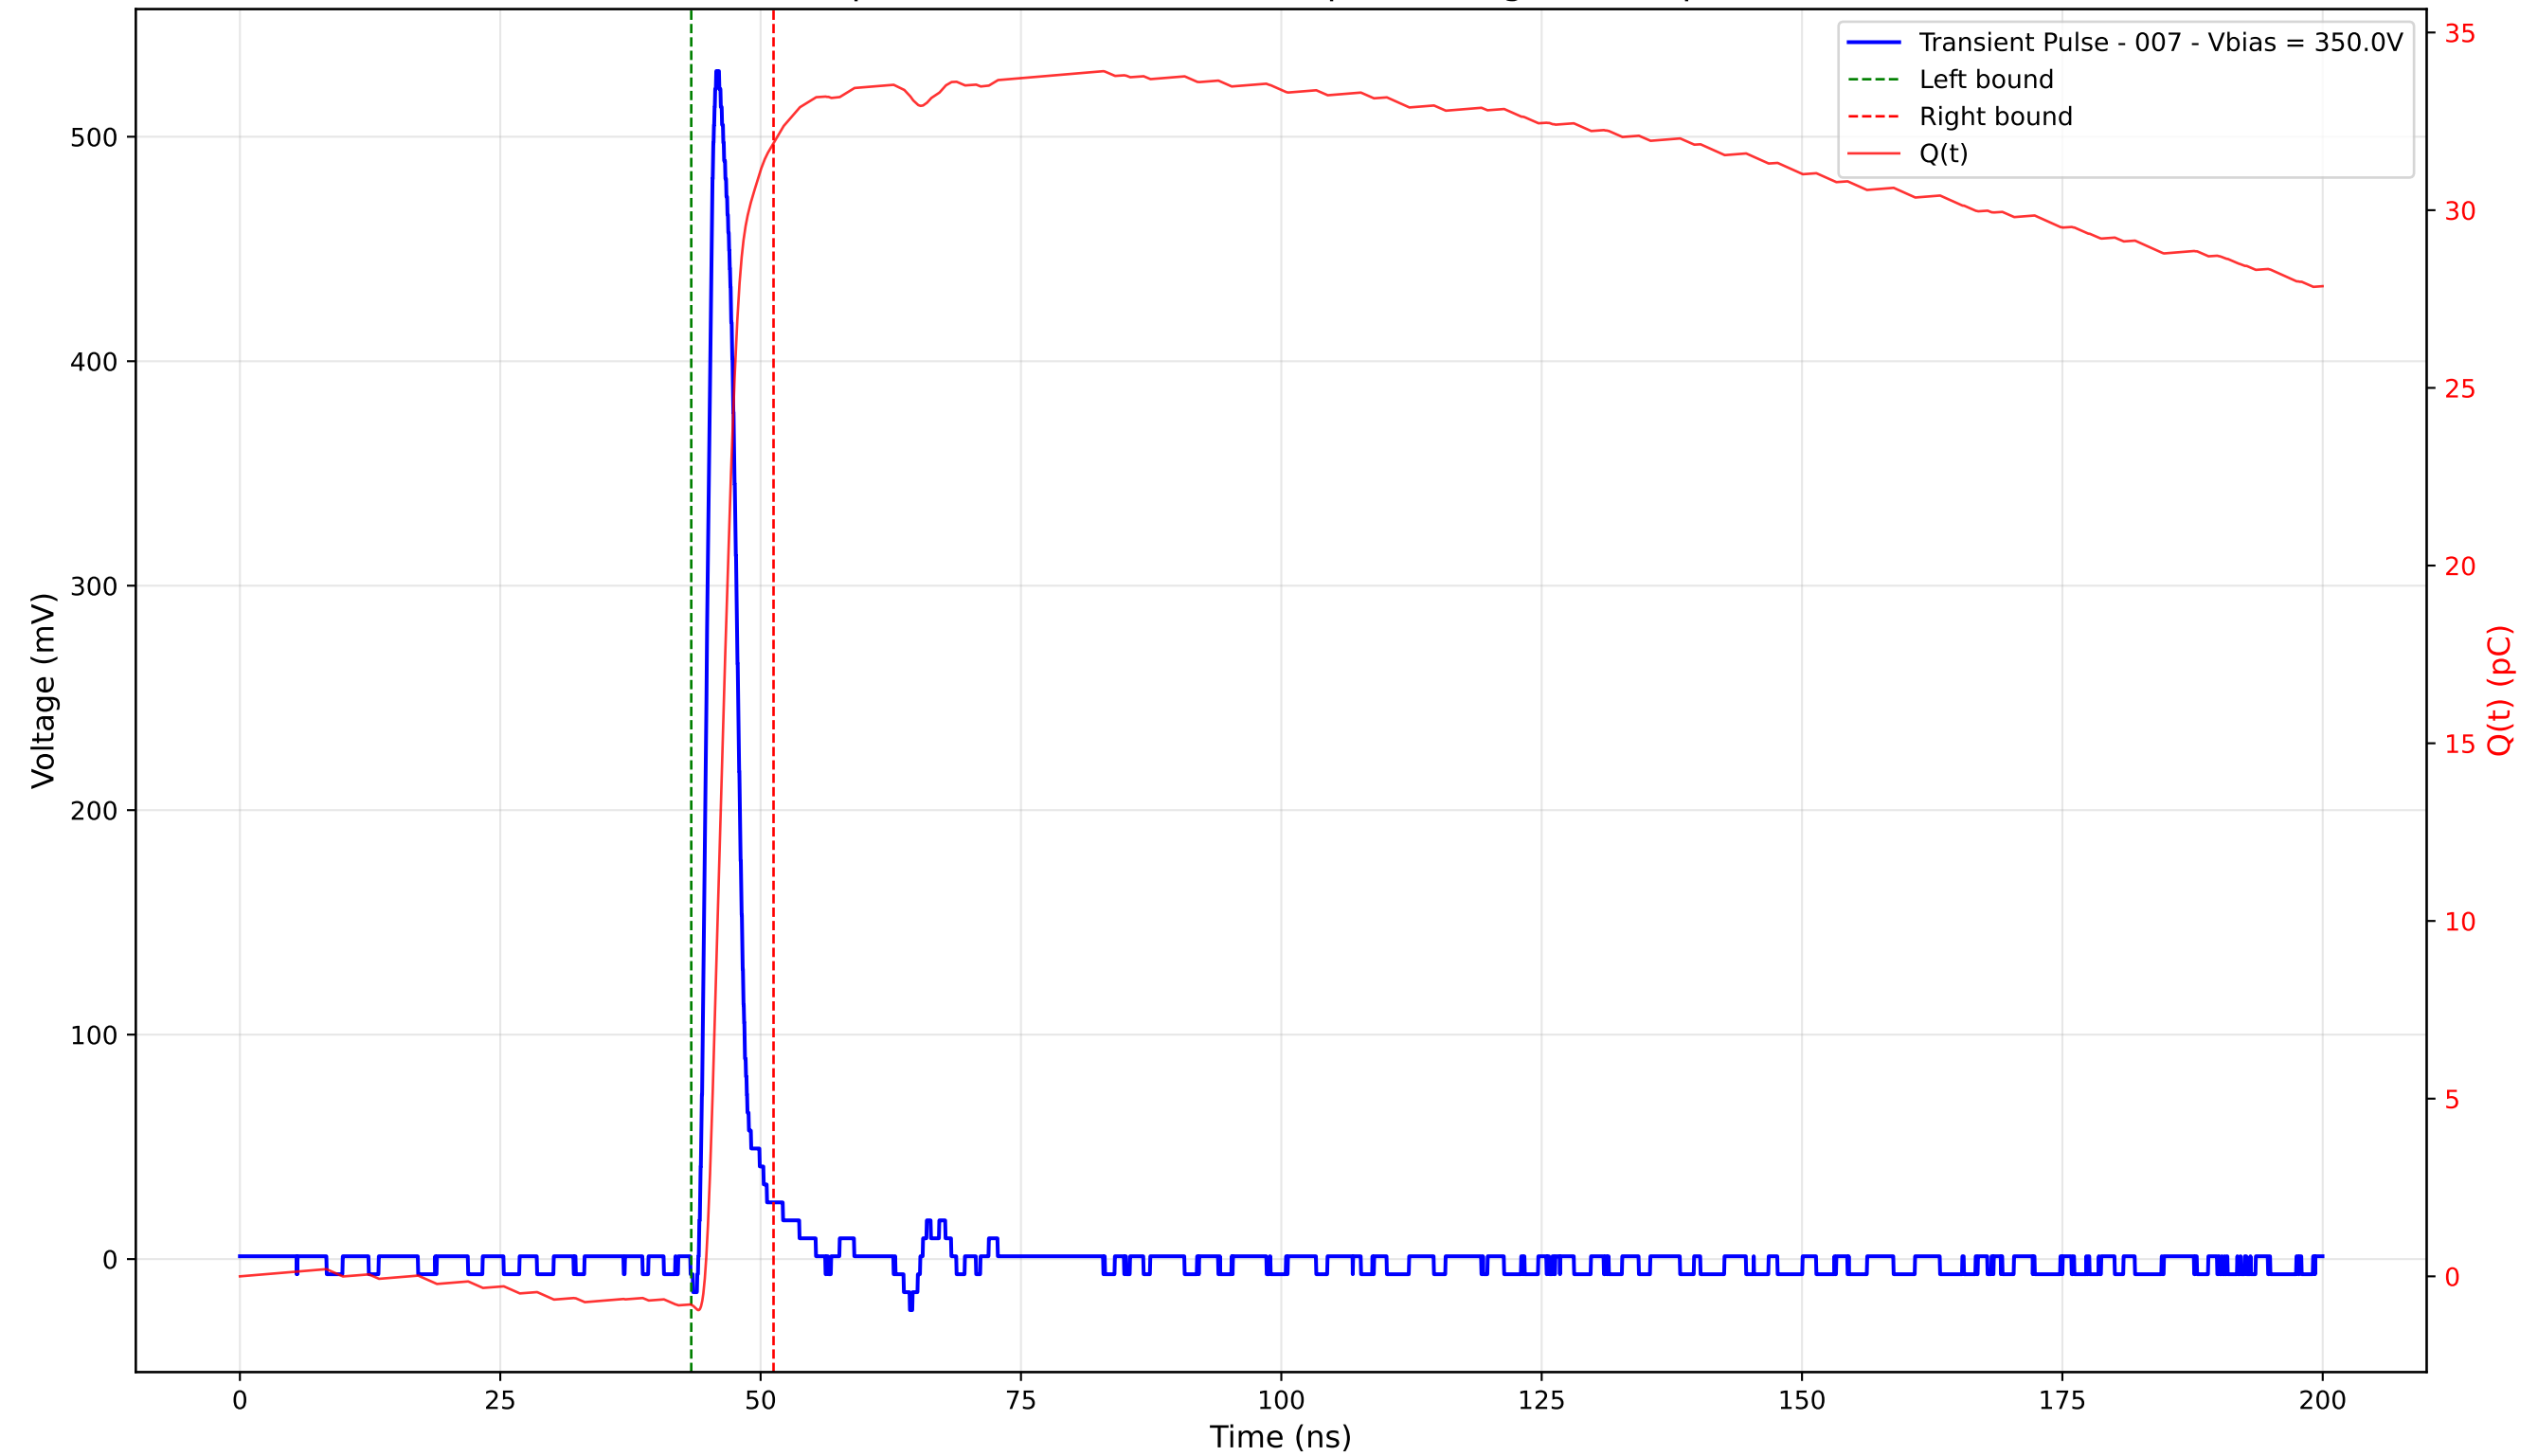


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 33.42 pC - Rise Time: 1.06 ns

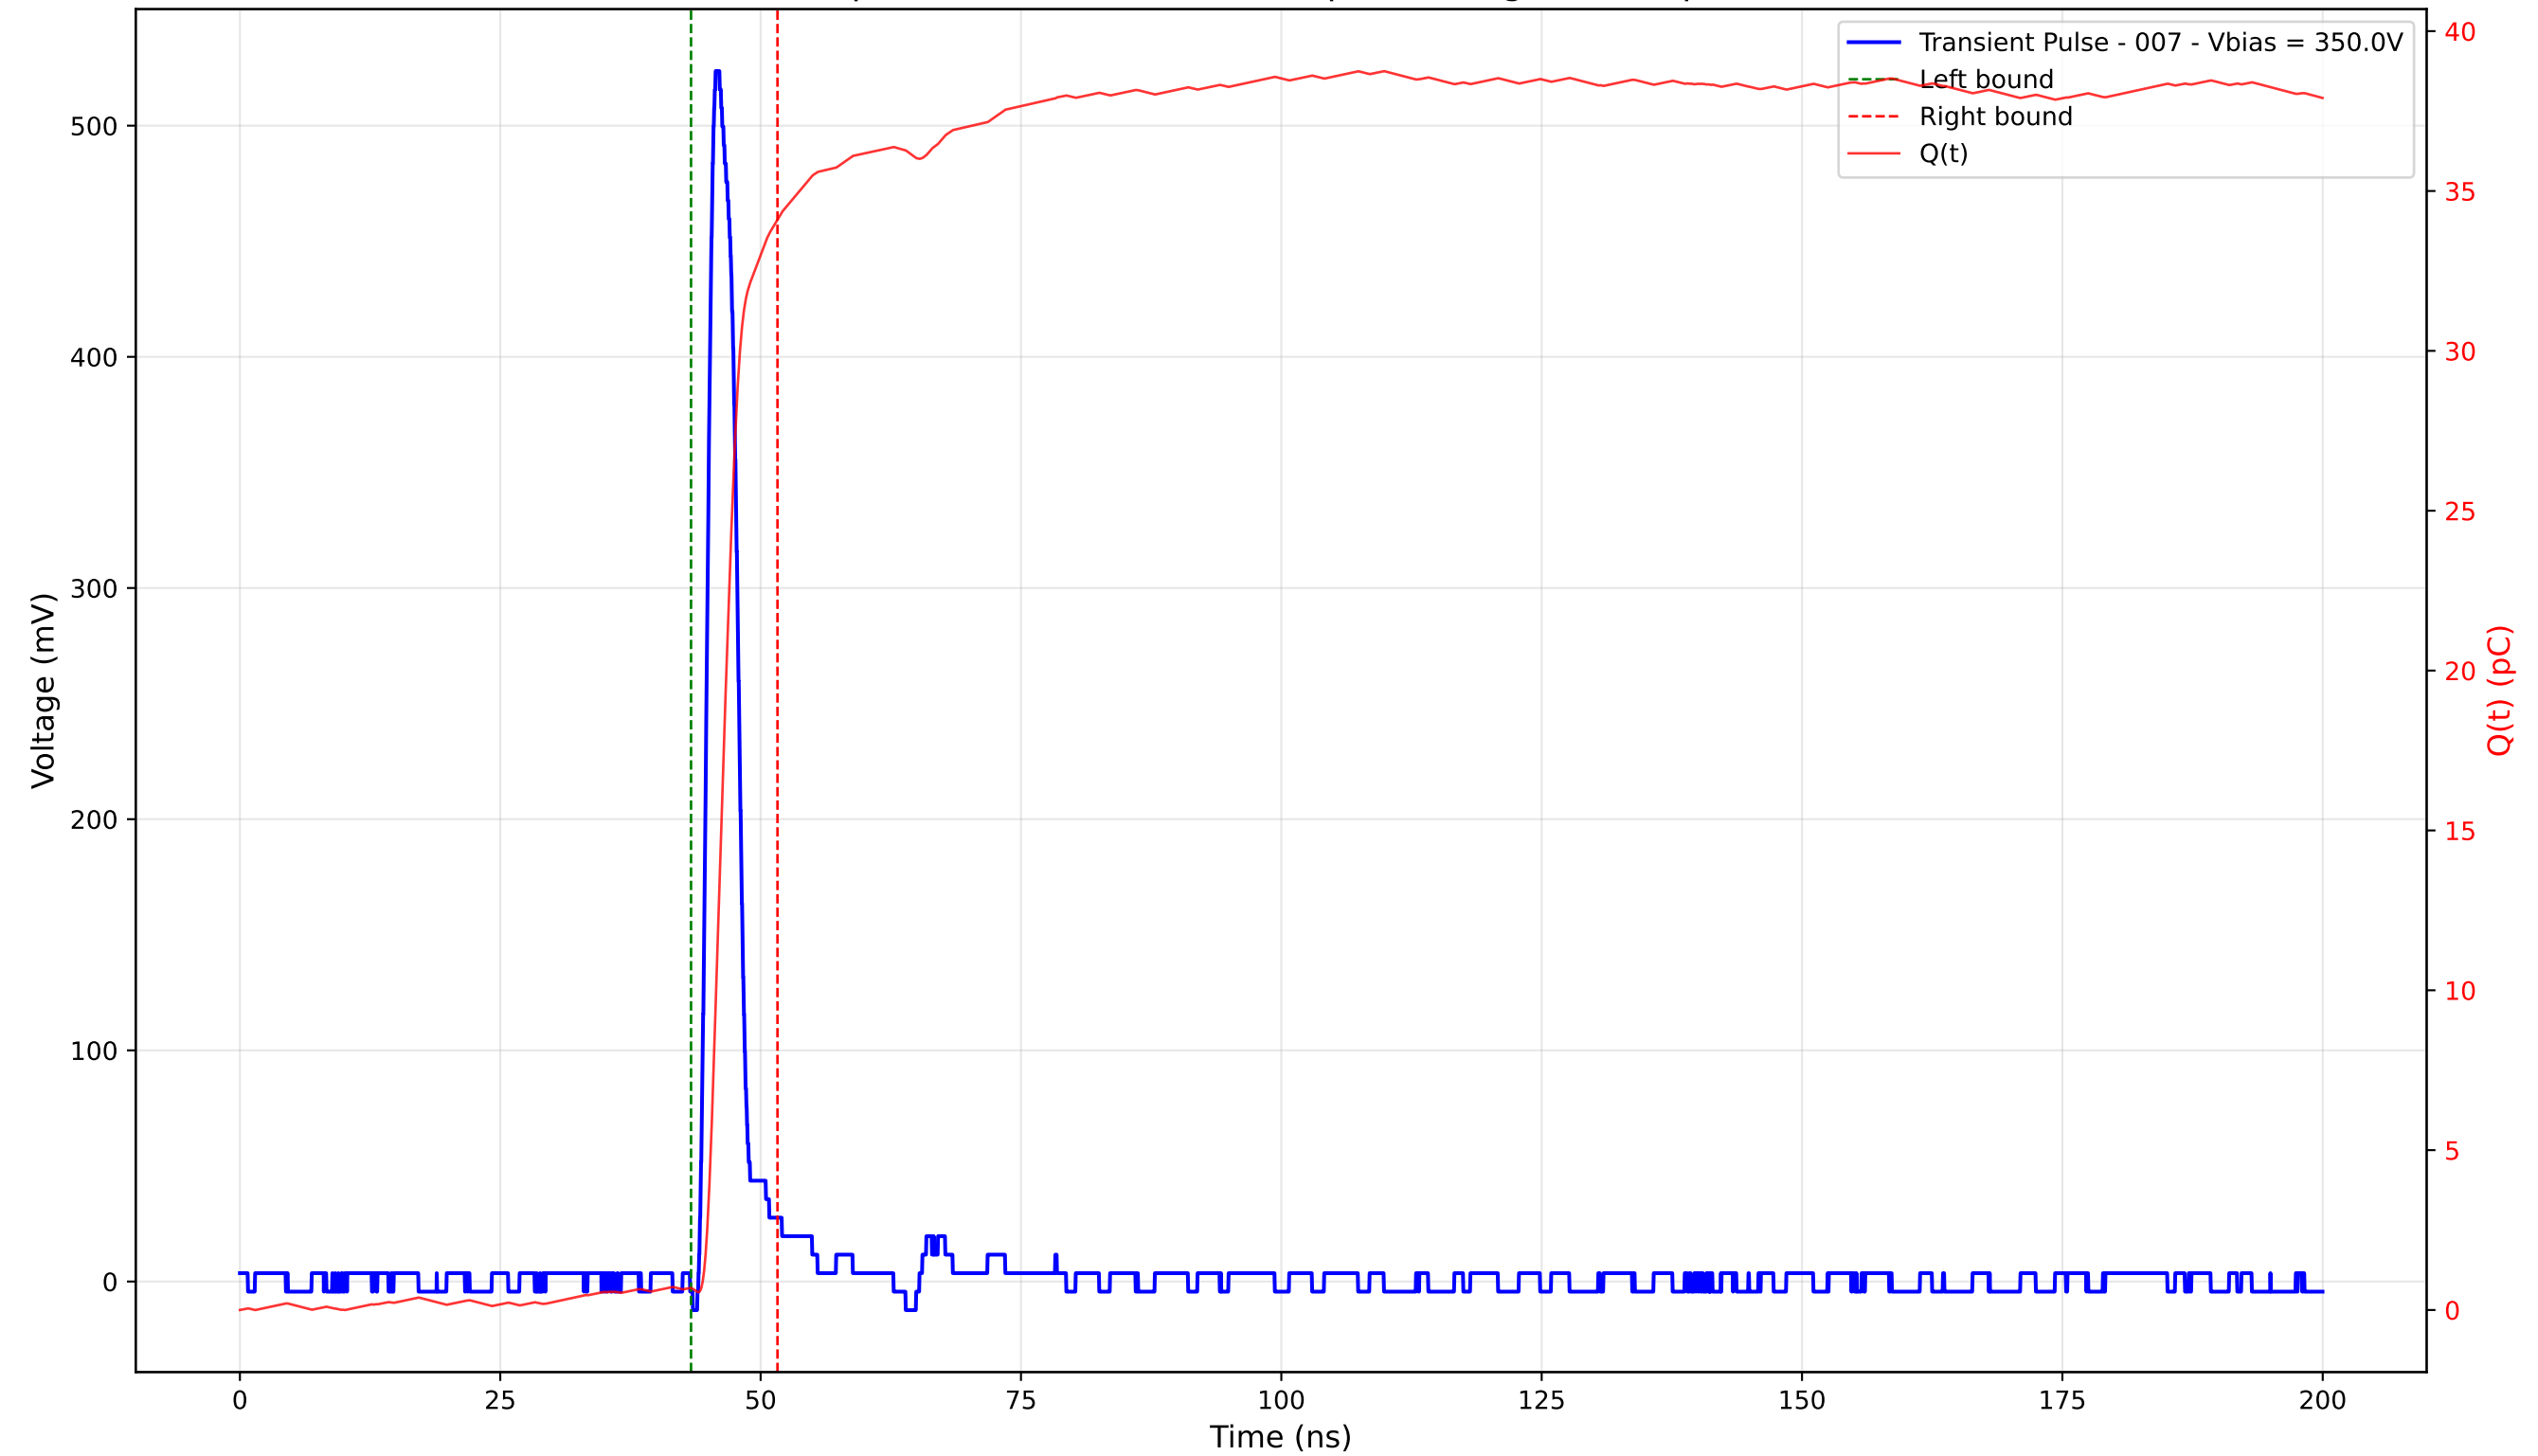


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 33.13 pC - Rise Time: 1.08 ns

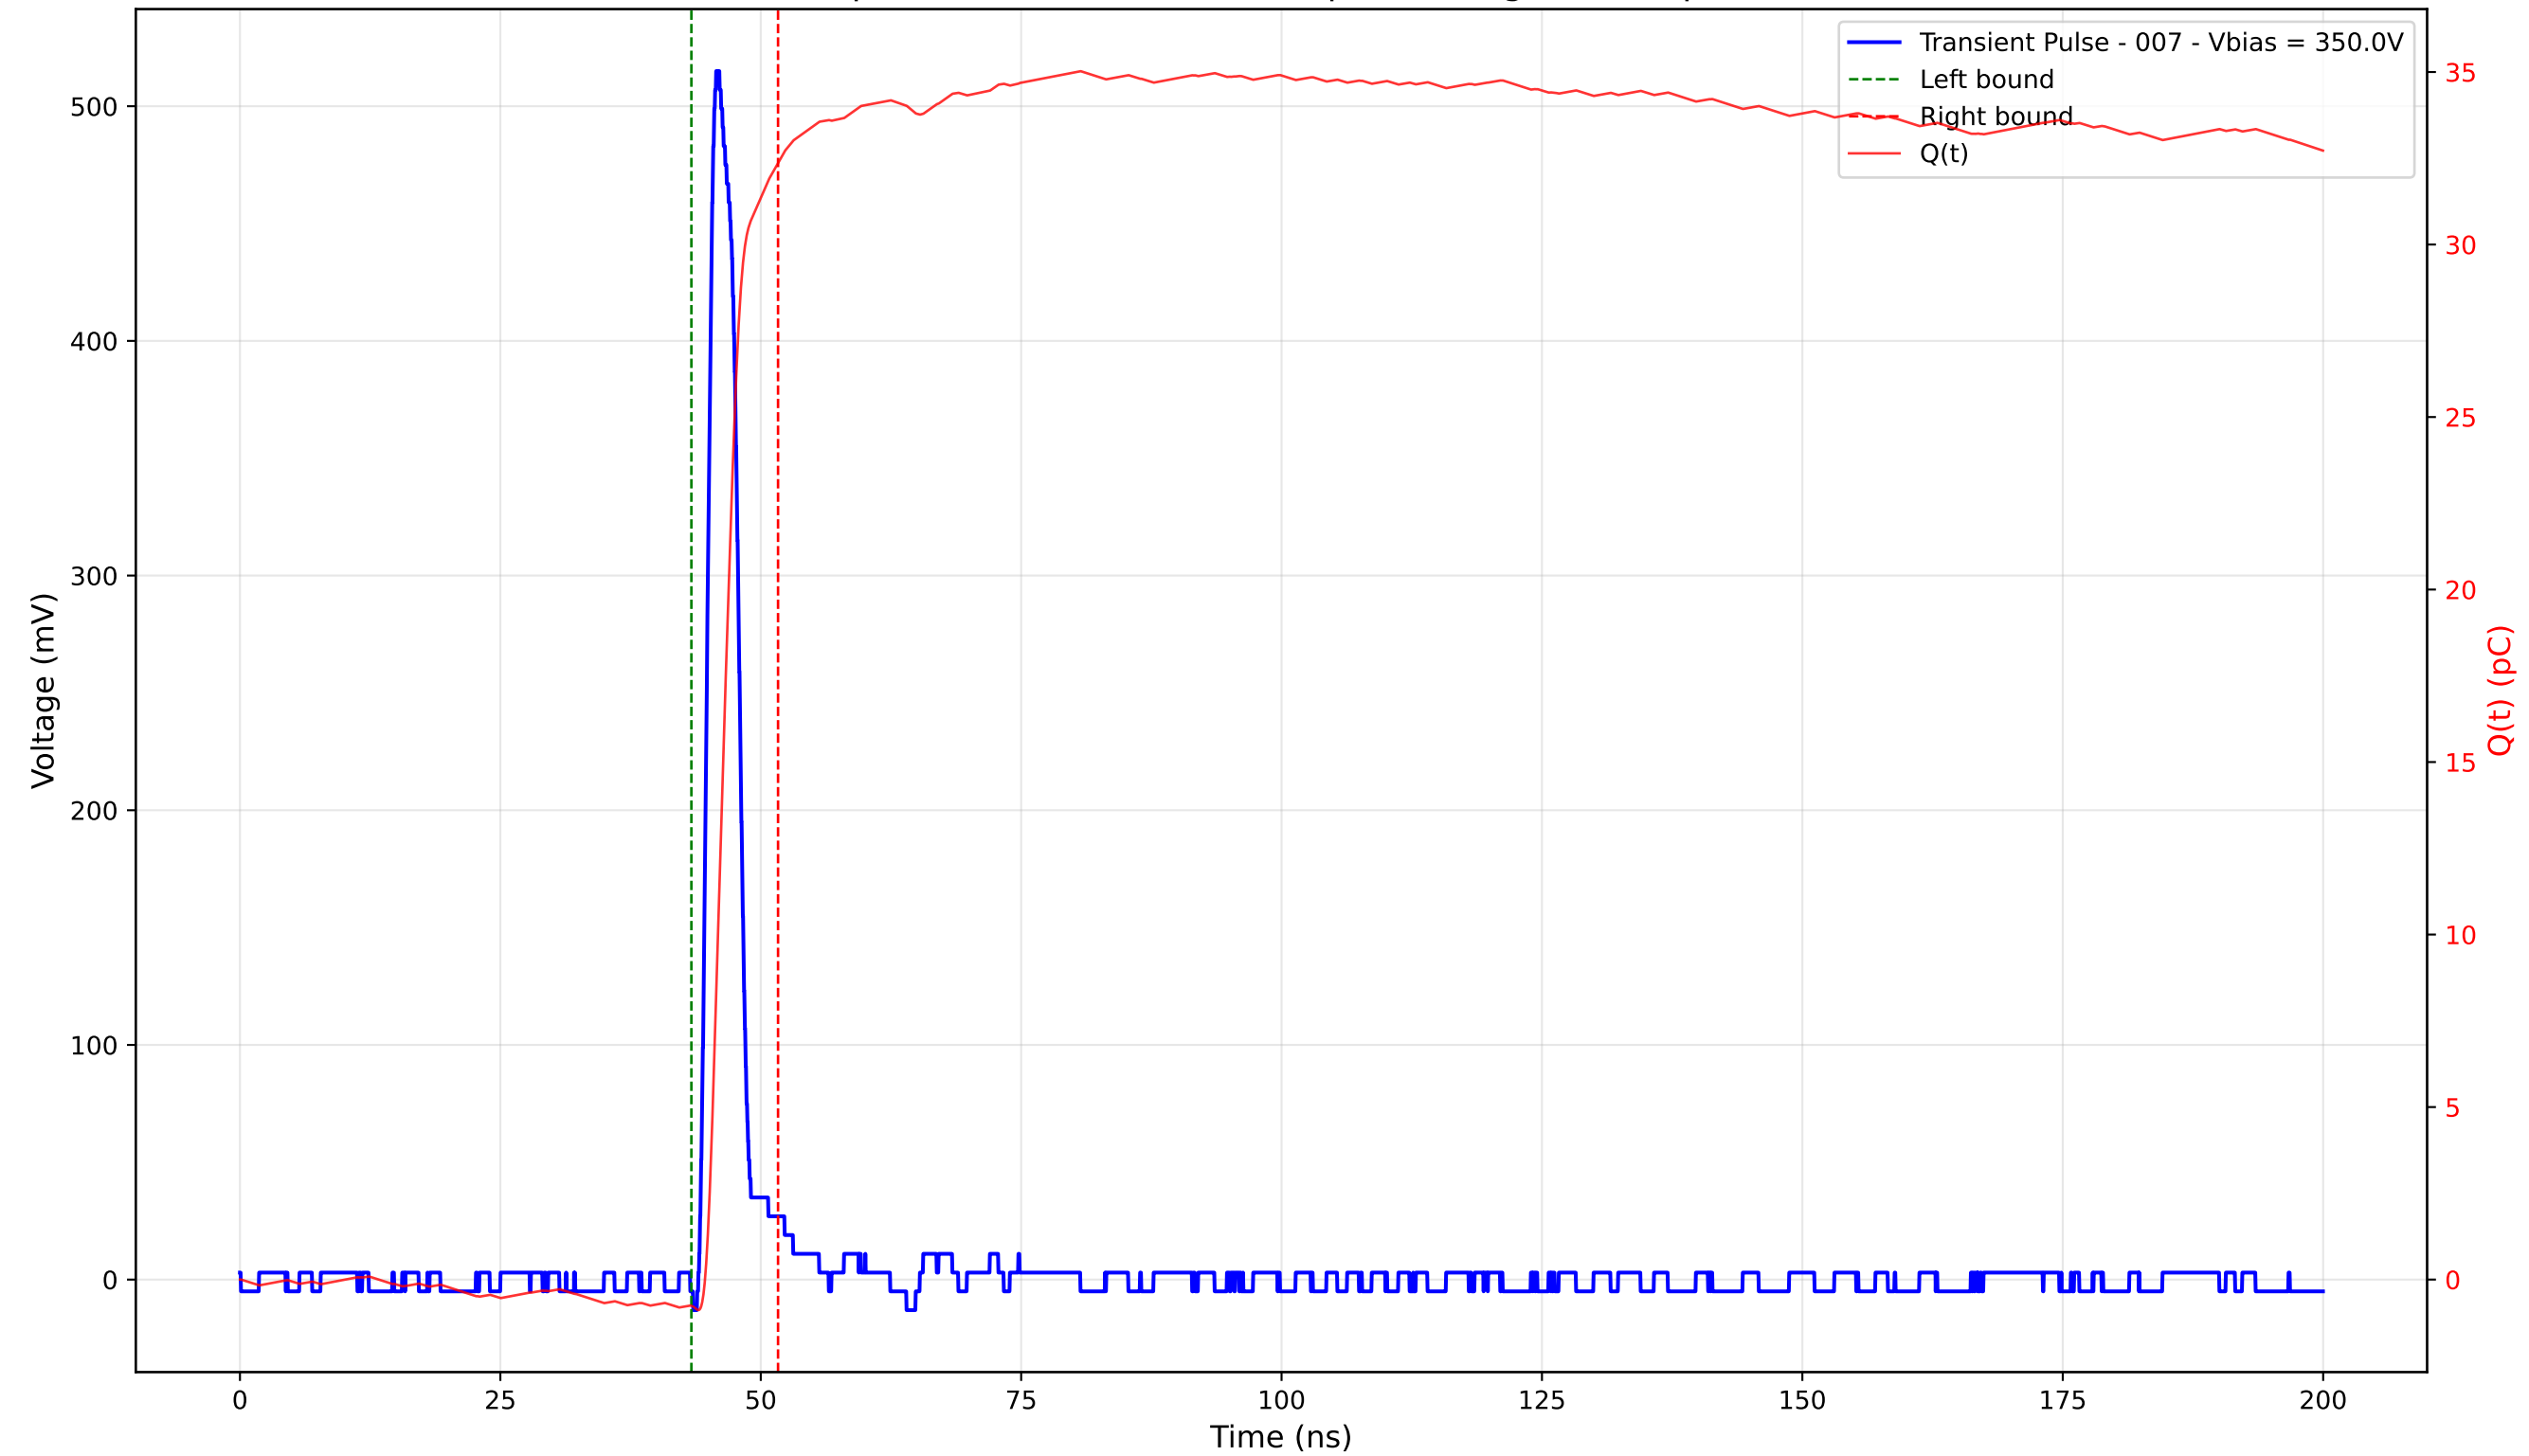


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 32.91 pC - Rise Time: 1.10 ns

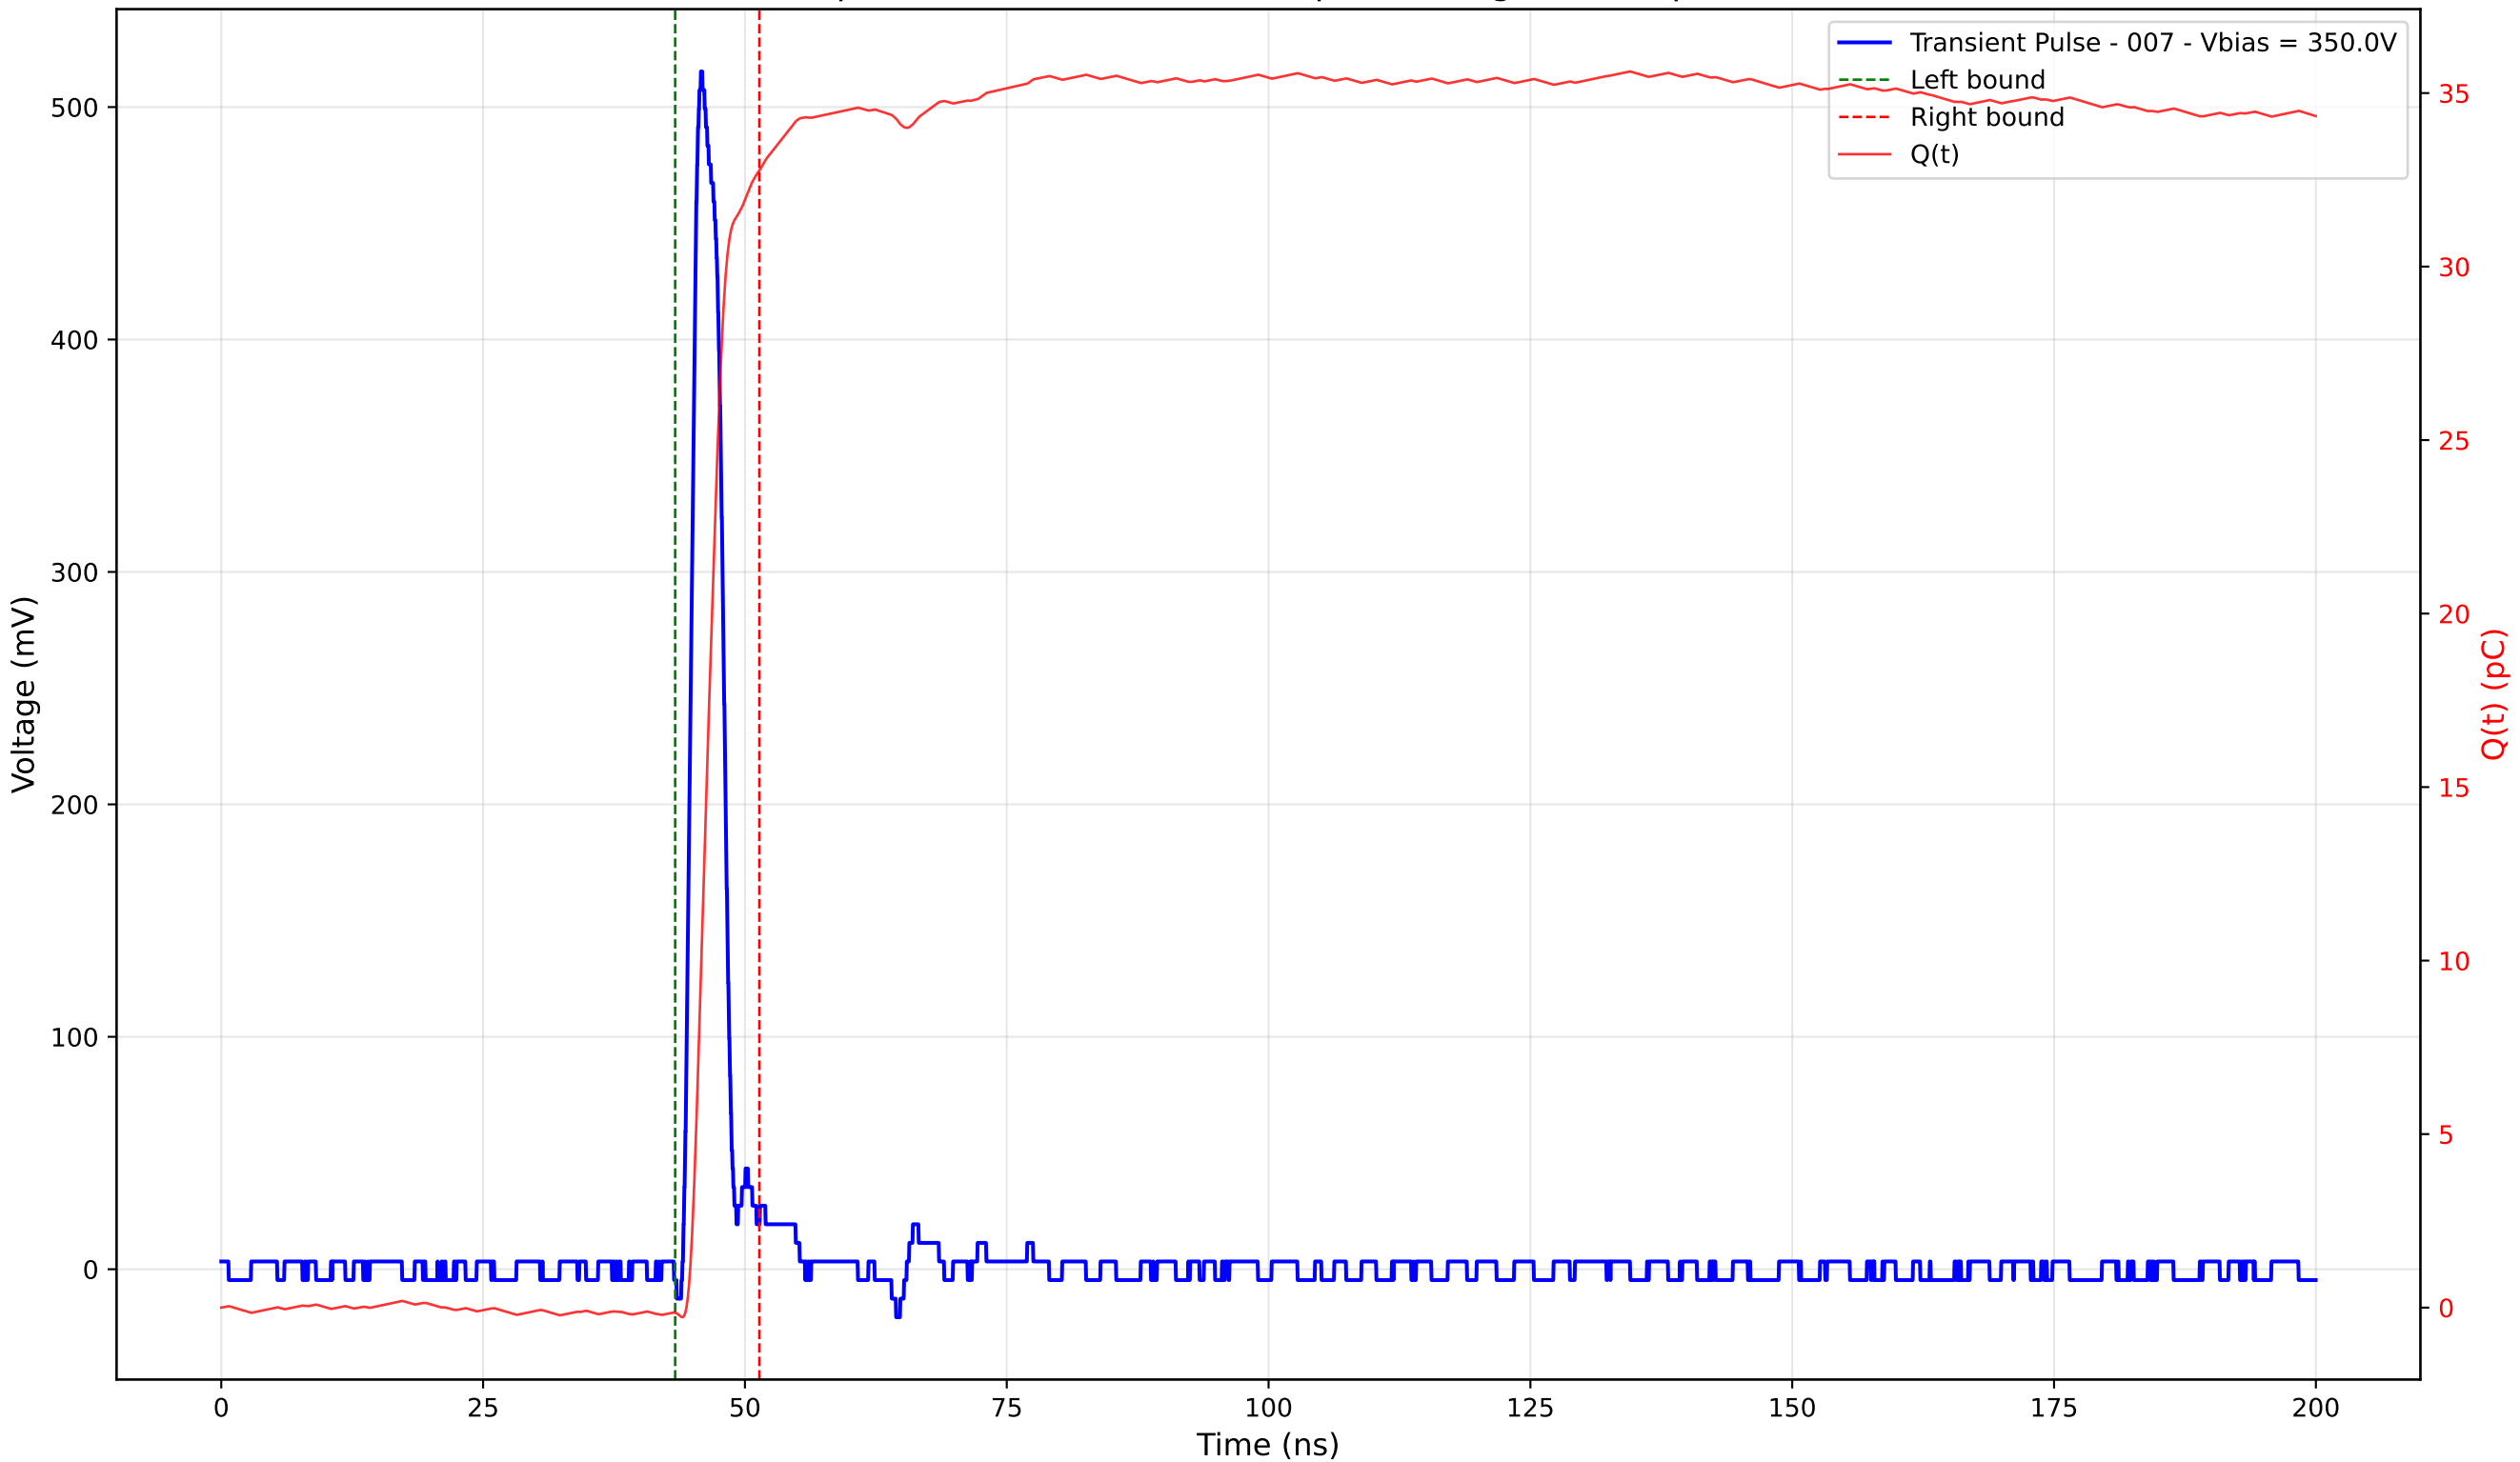


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 33.43 pC - Rise Time: 1.08 ns

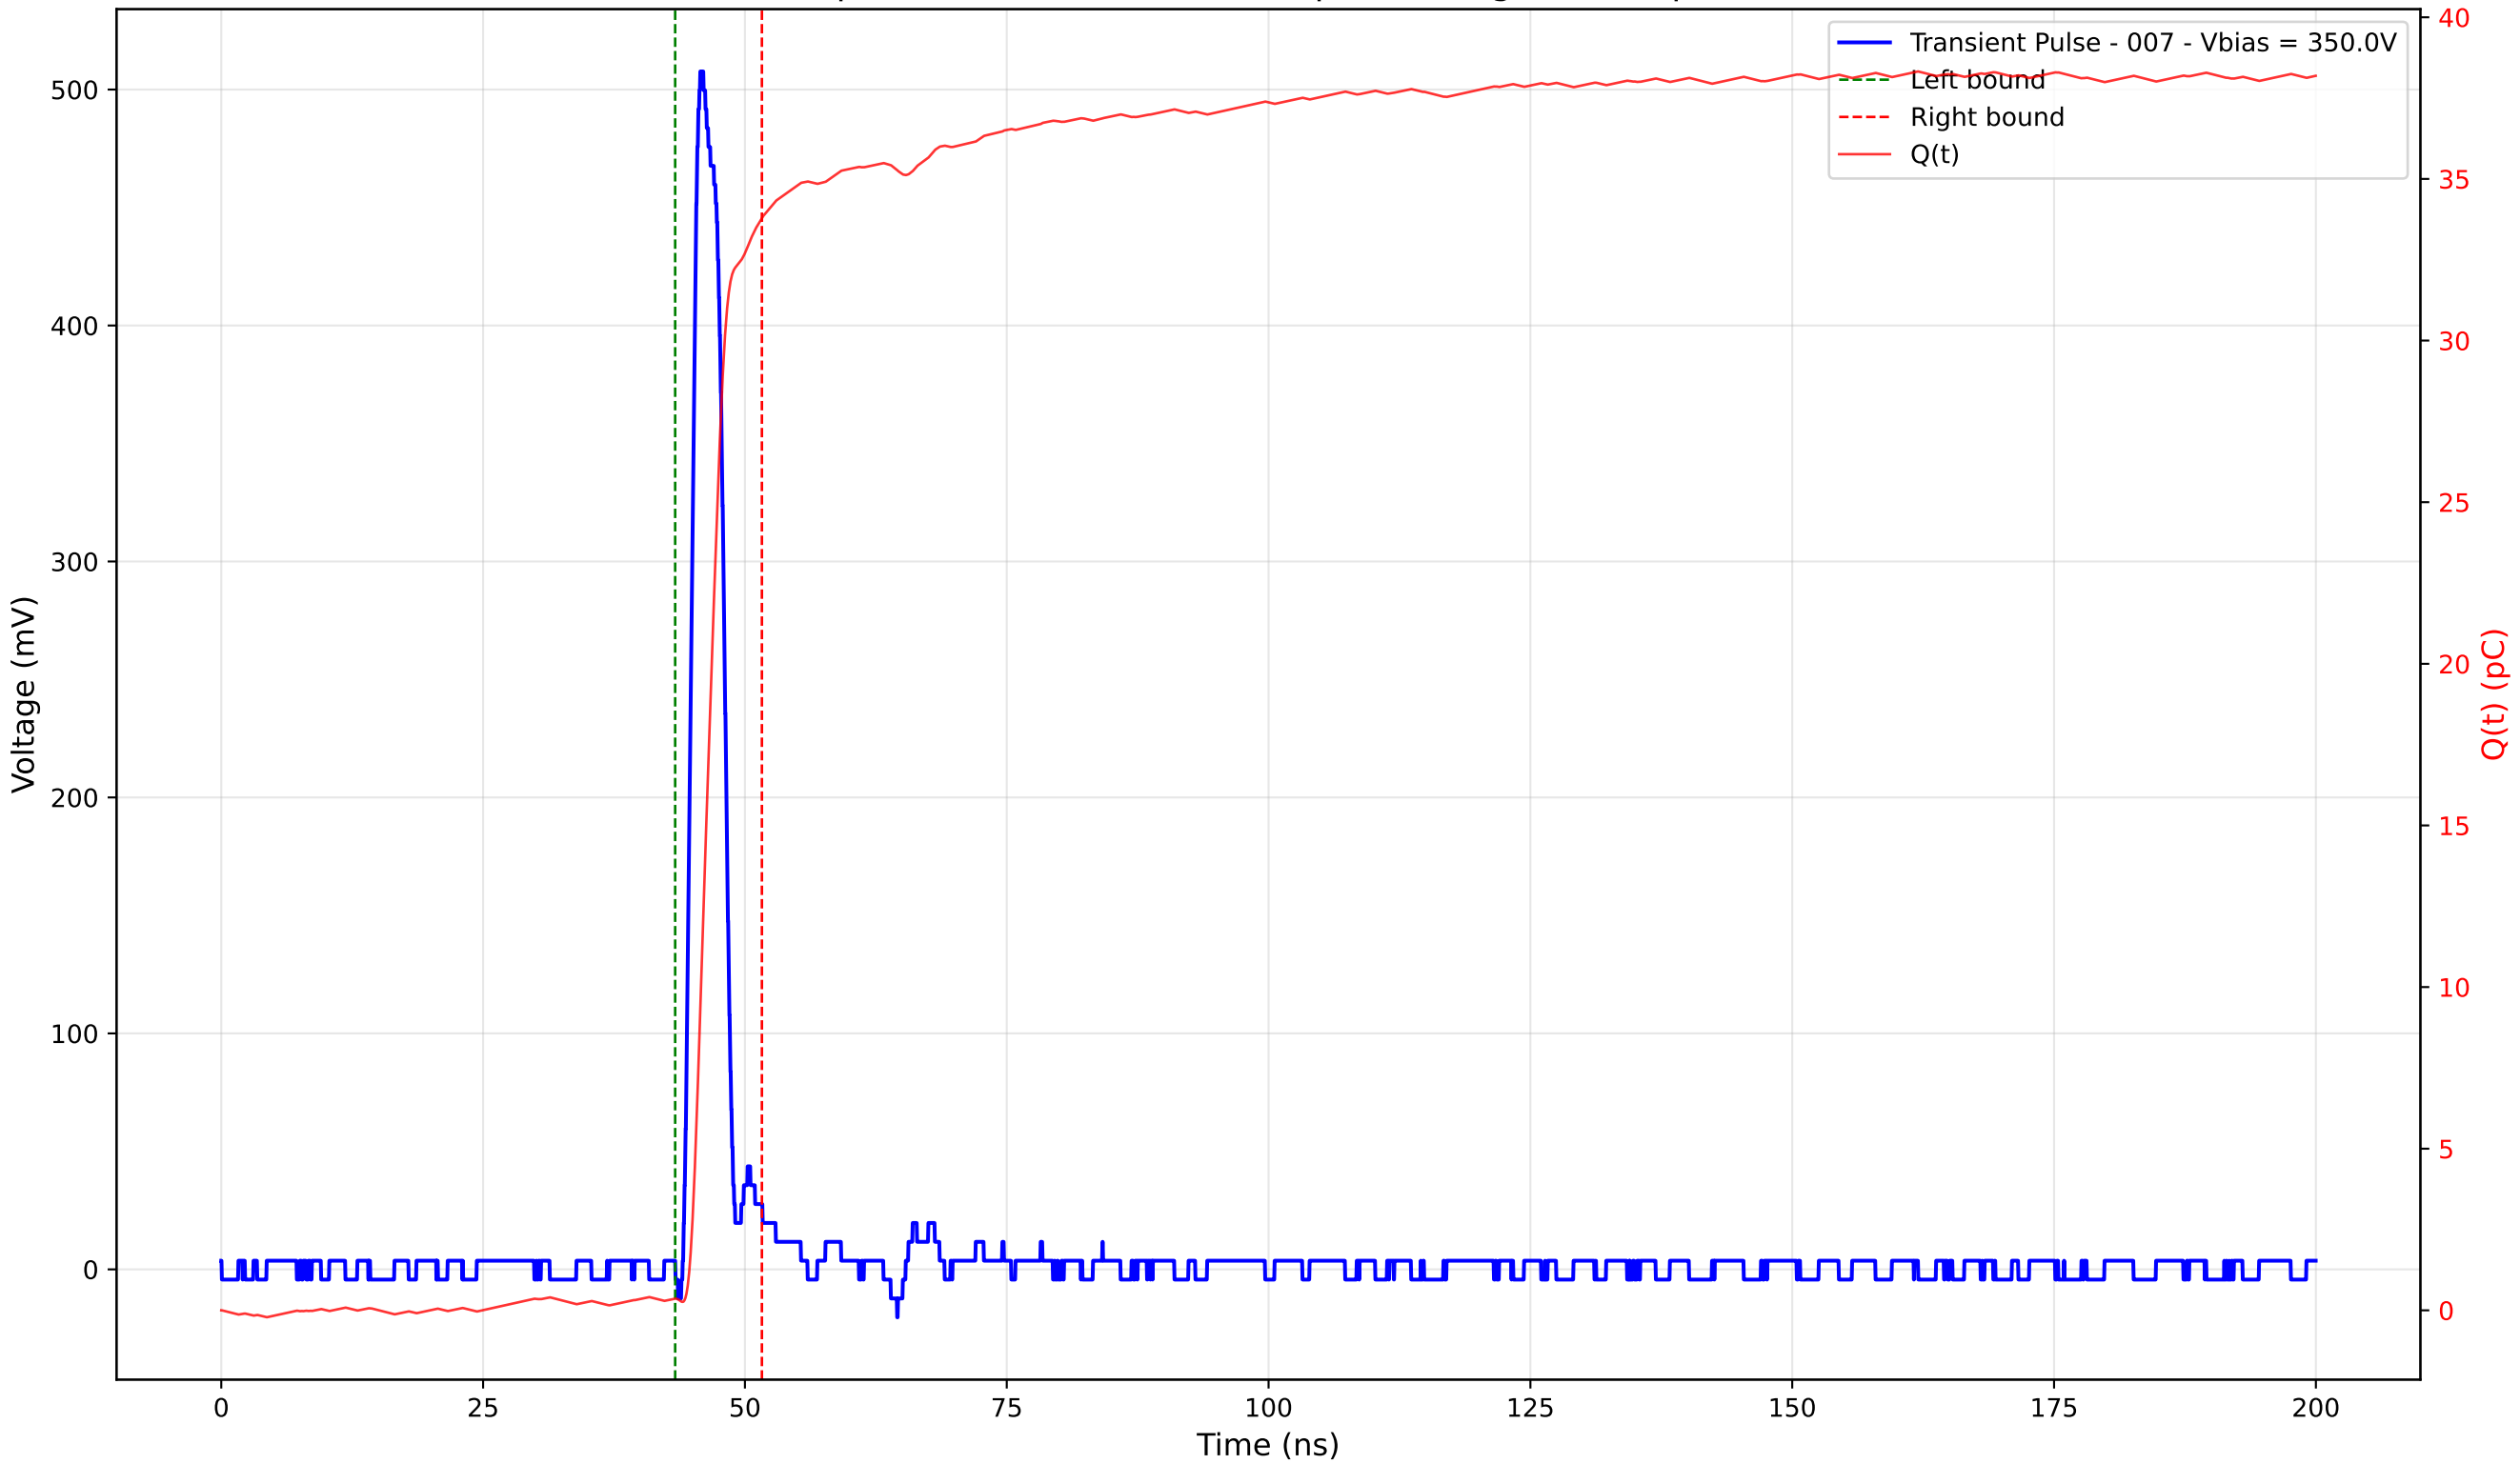


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 31.54 pC - Rise Time: 1.08 ns

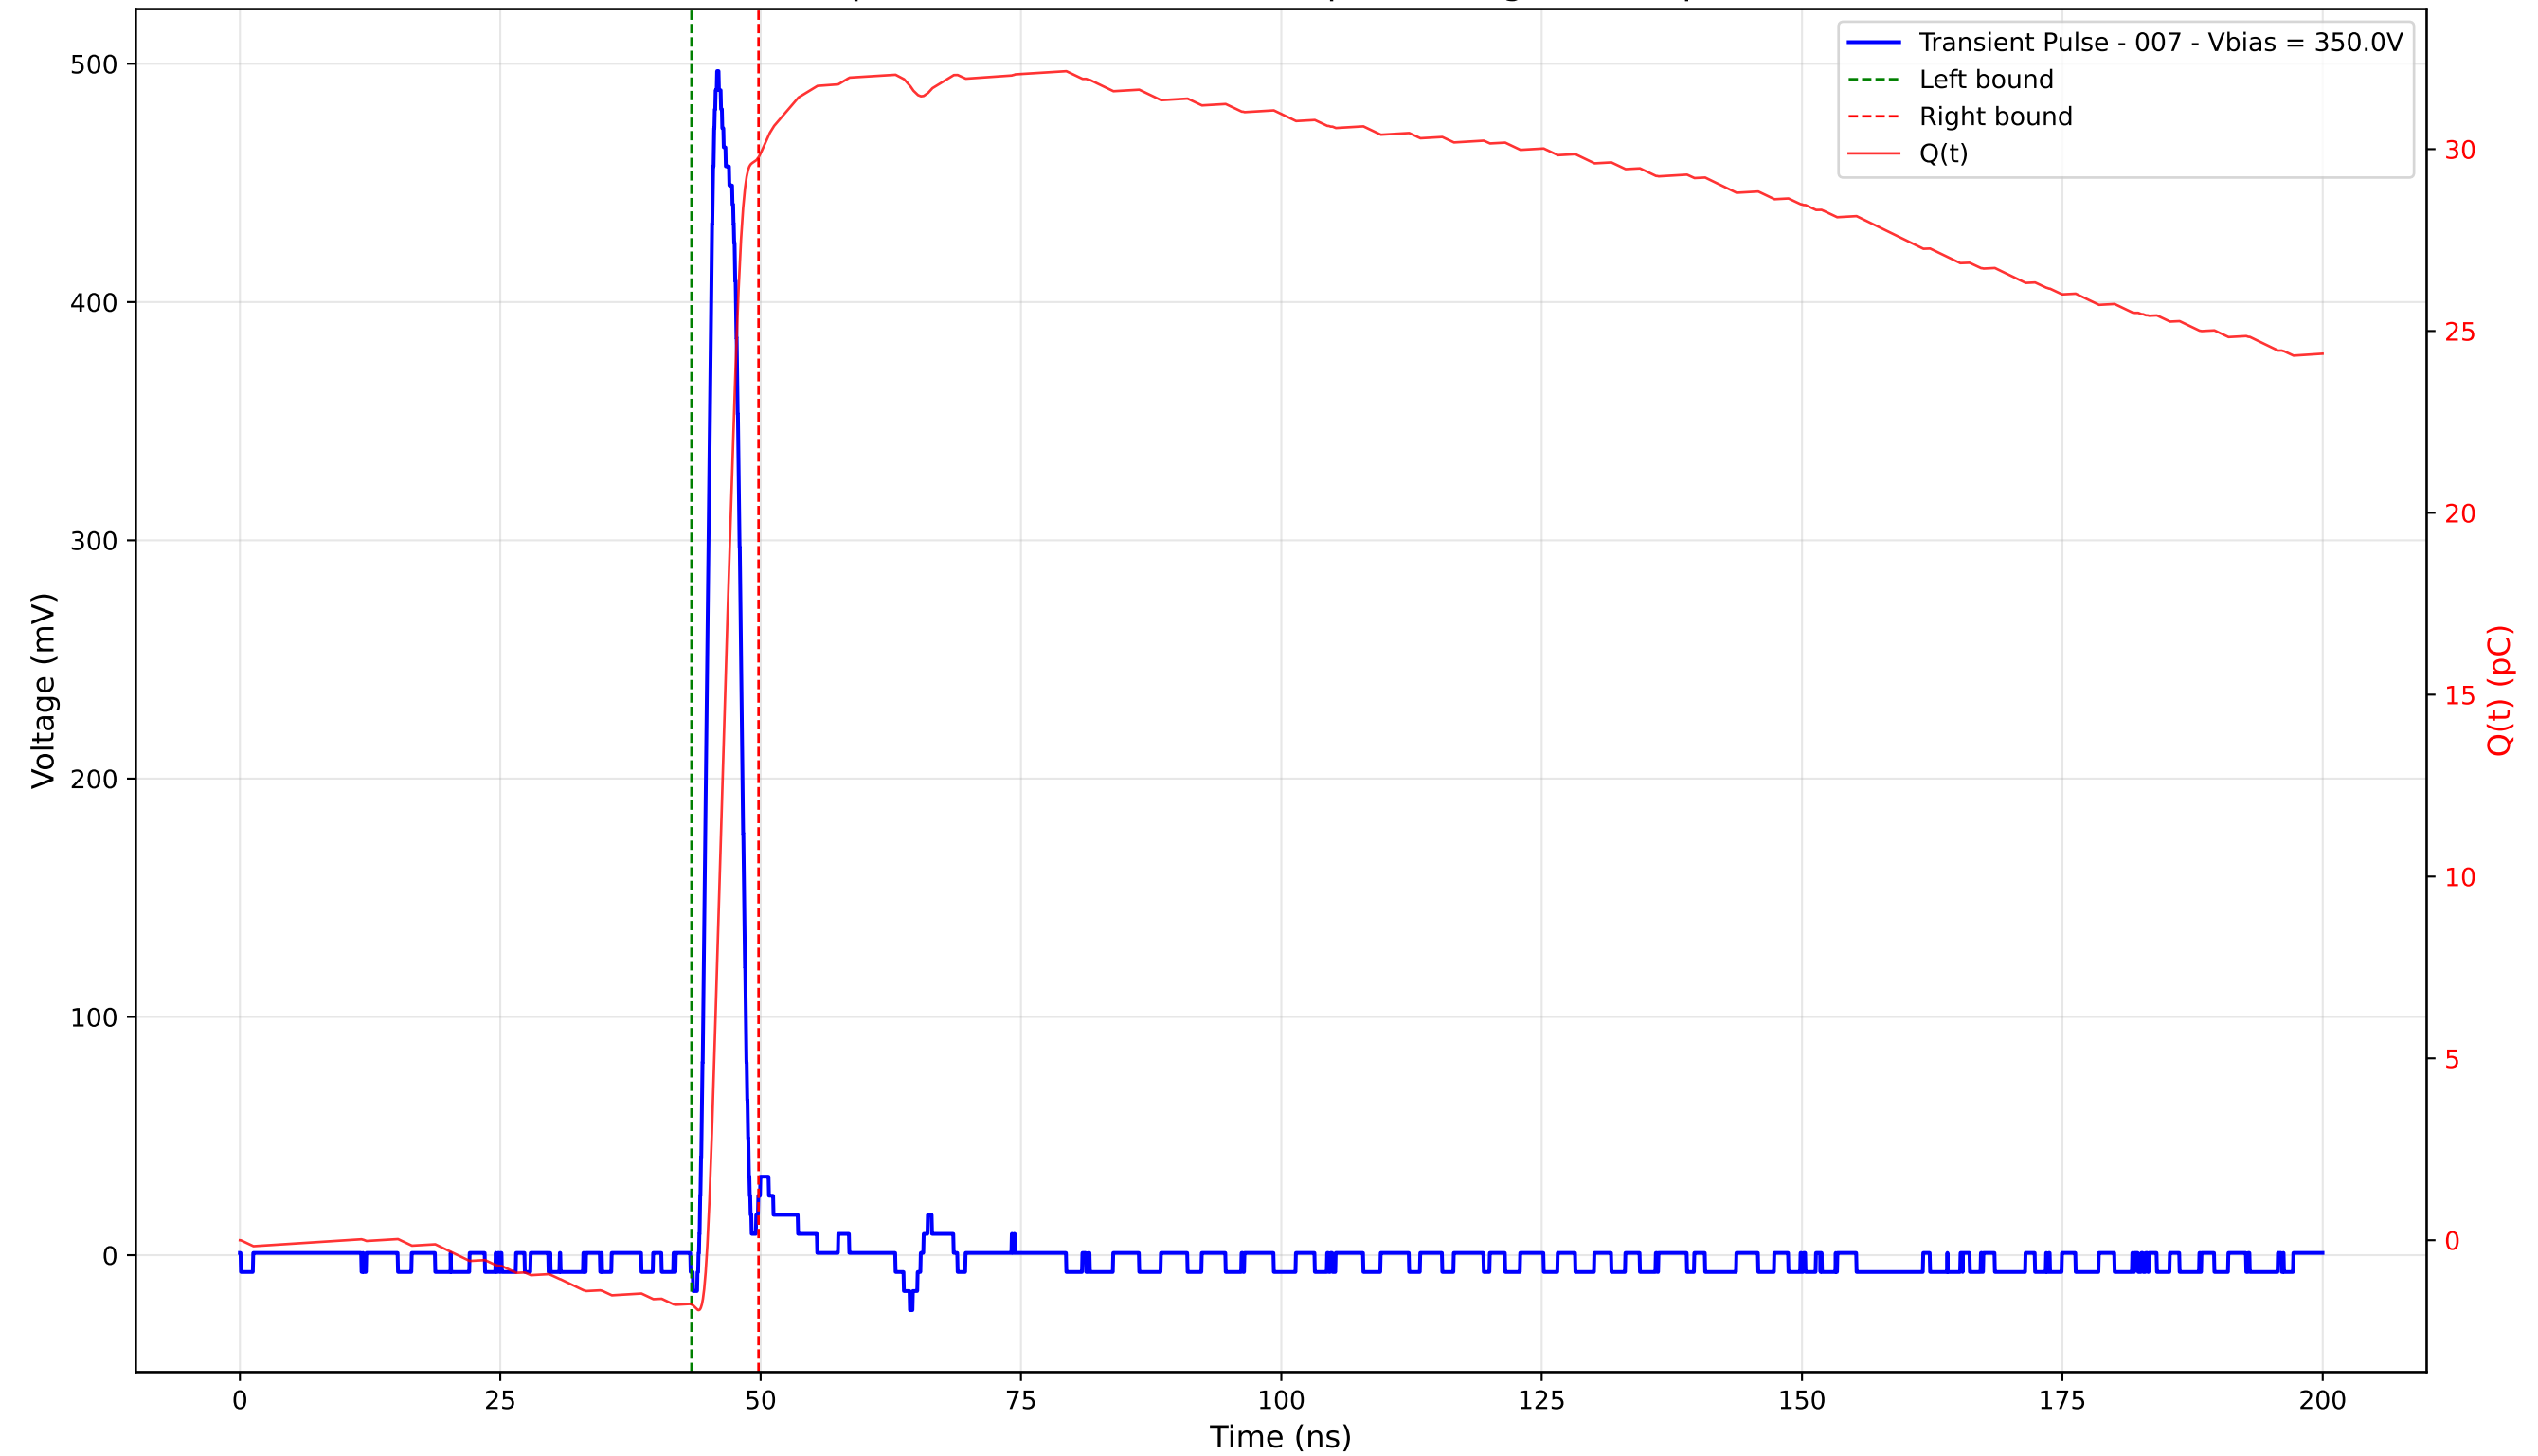


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 32.10 pC - Rise Time: 1.06 ns

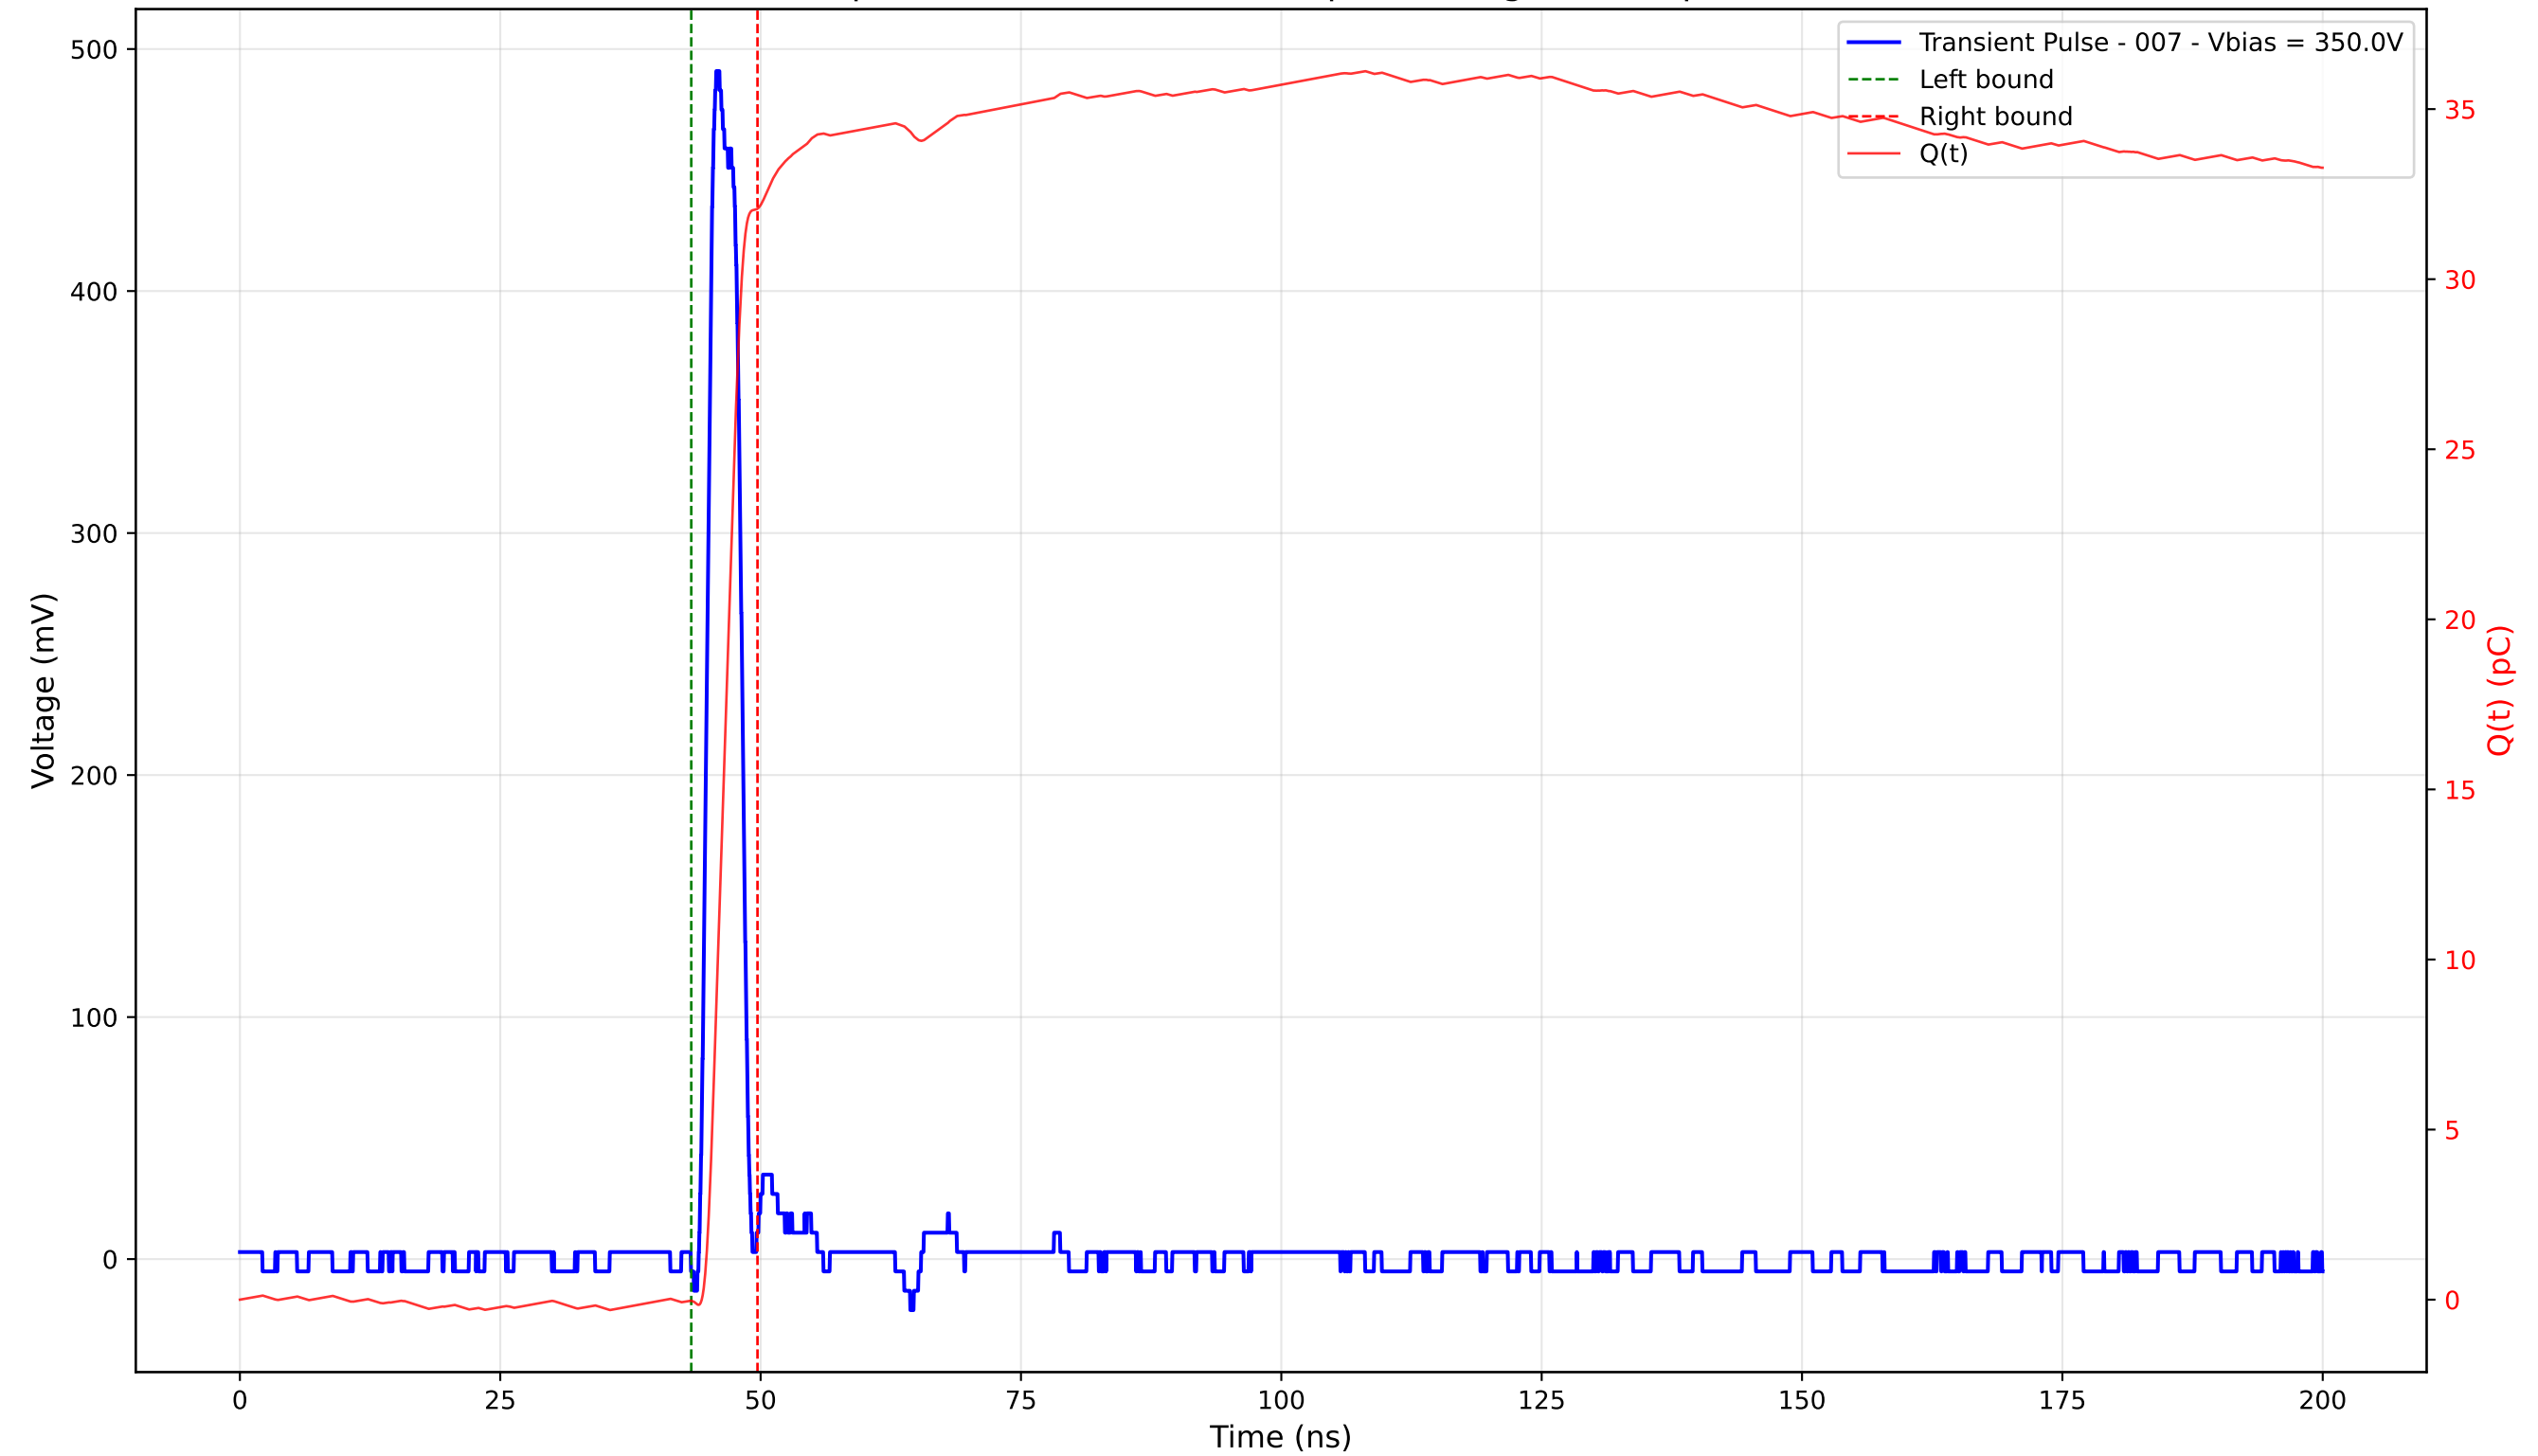


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 31.64 pC - Rise Time: 1.11 ns

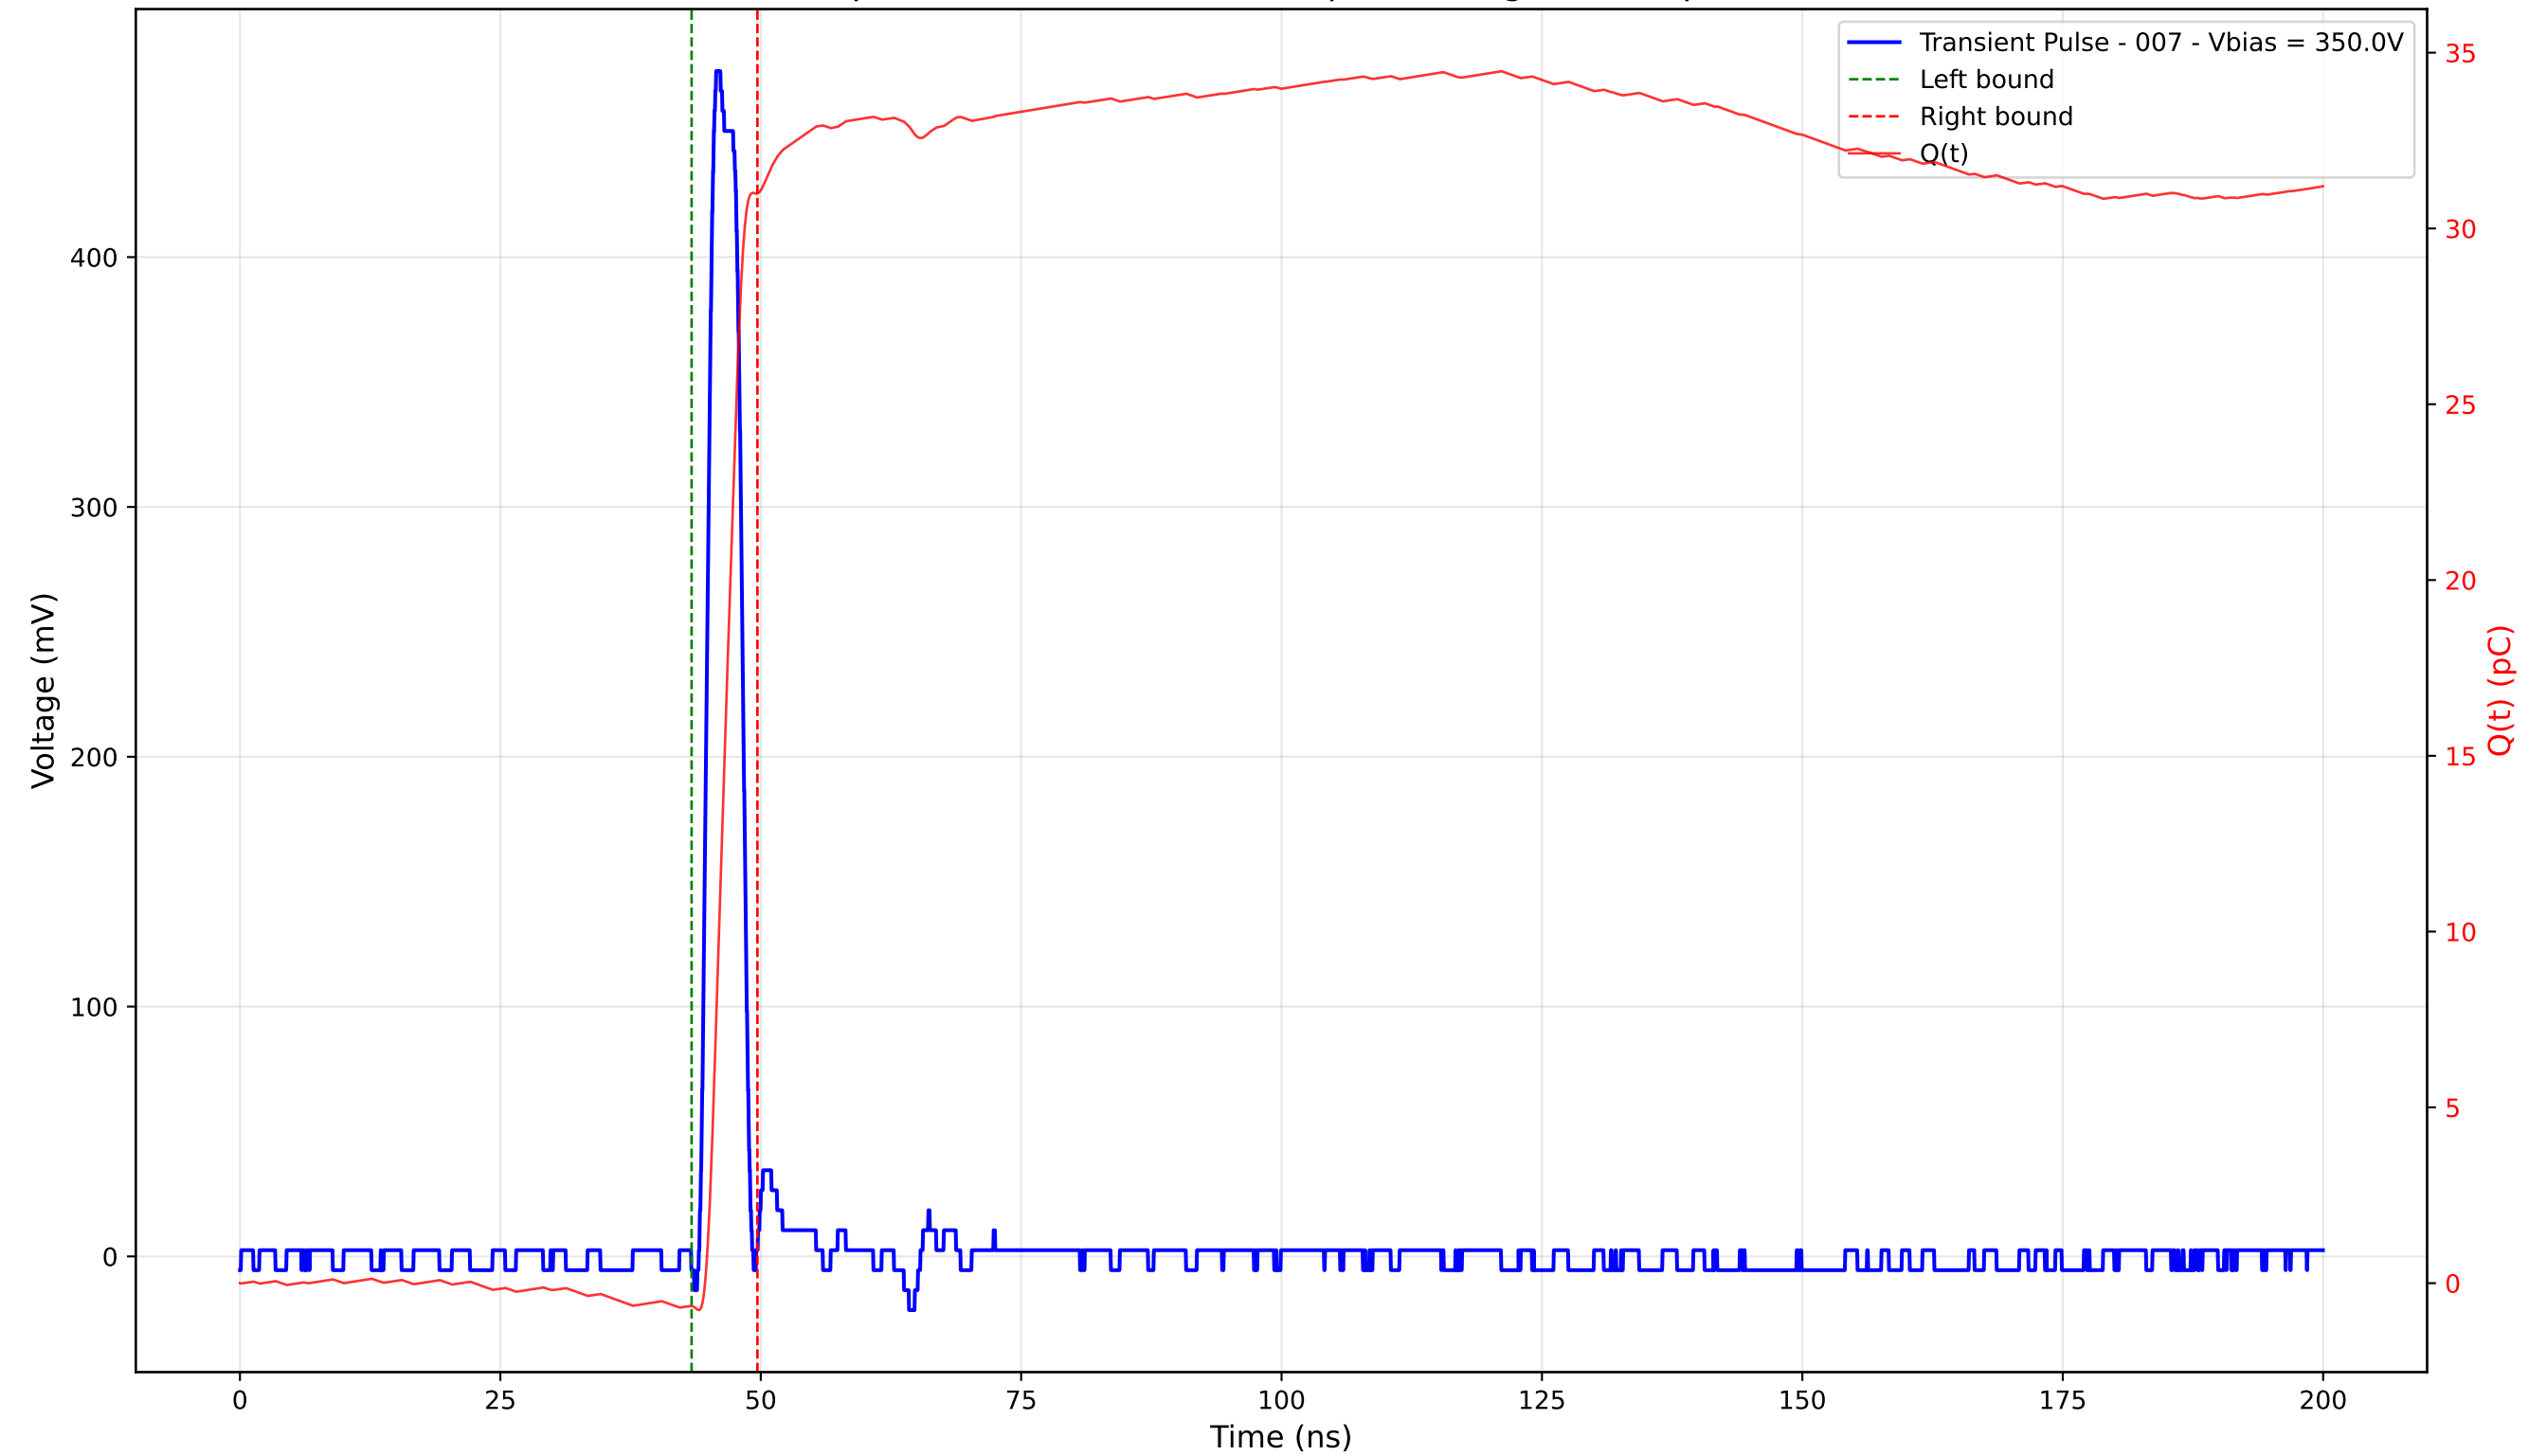


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 32.11 pC - Rise Time: 1.13 ns

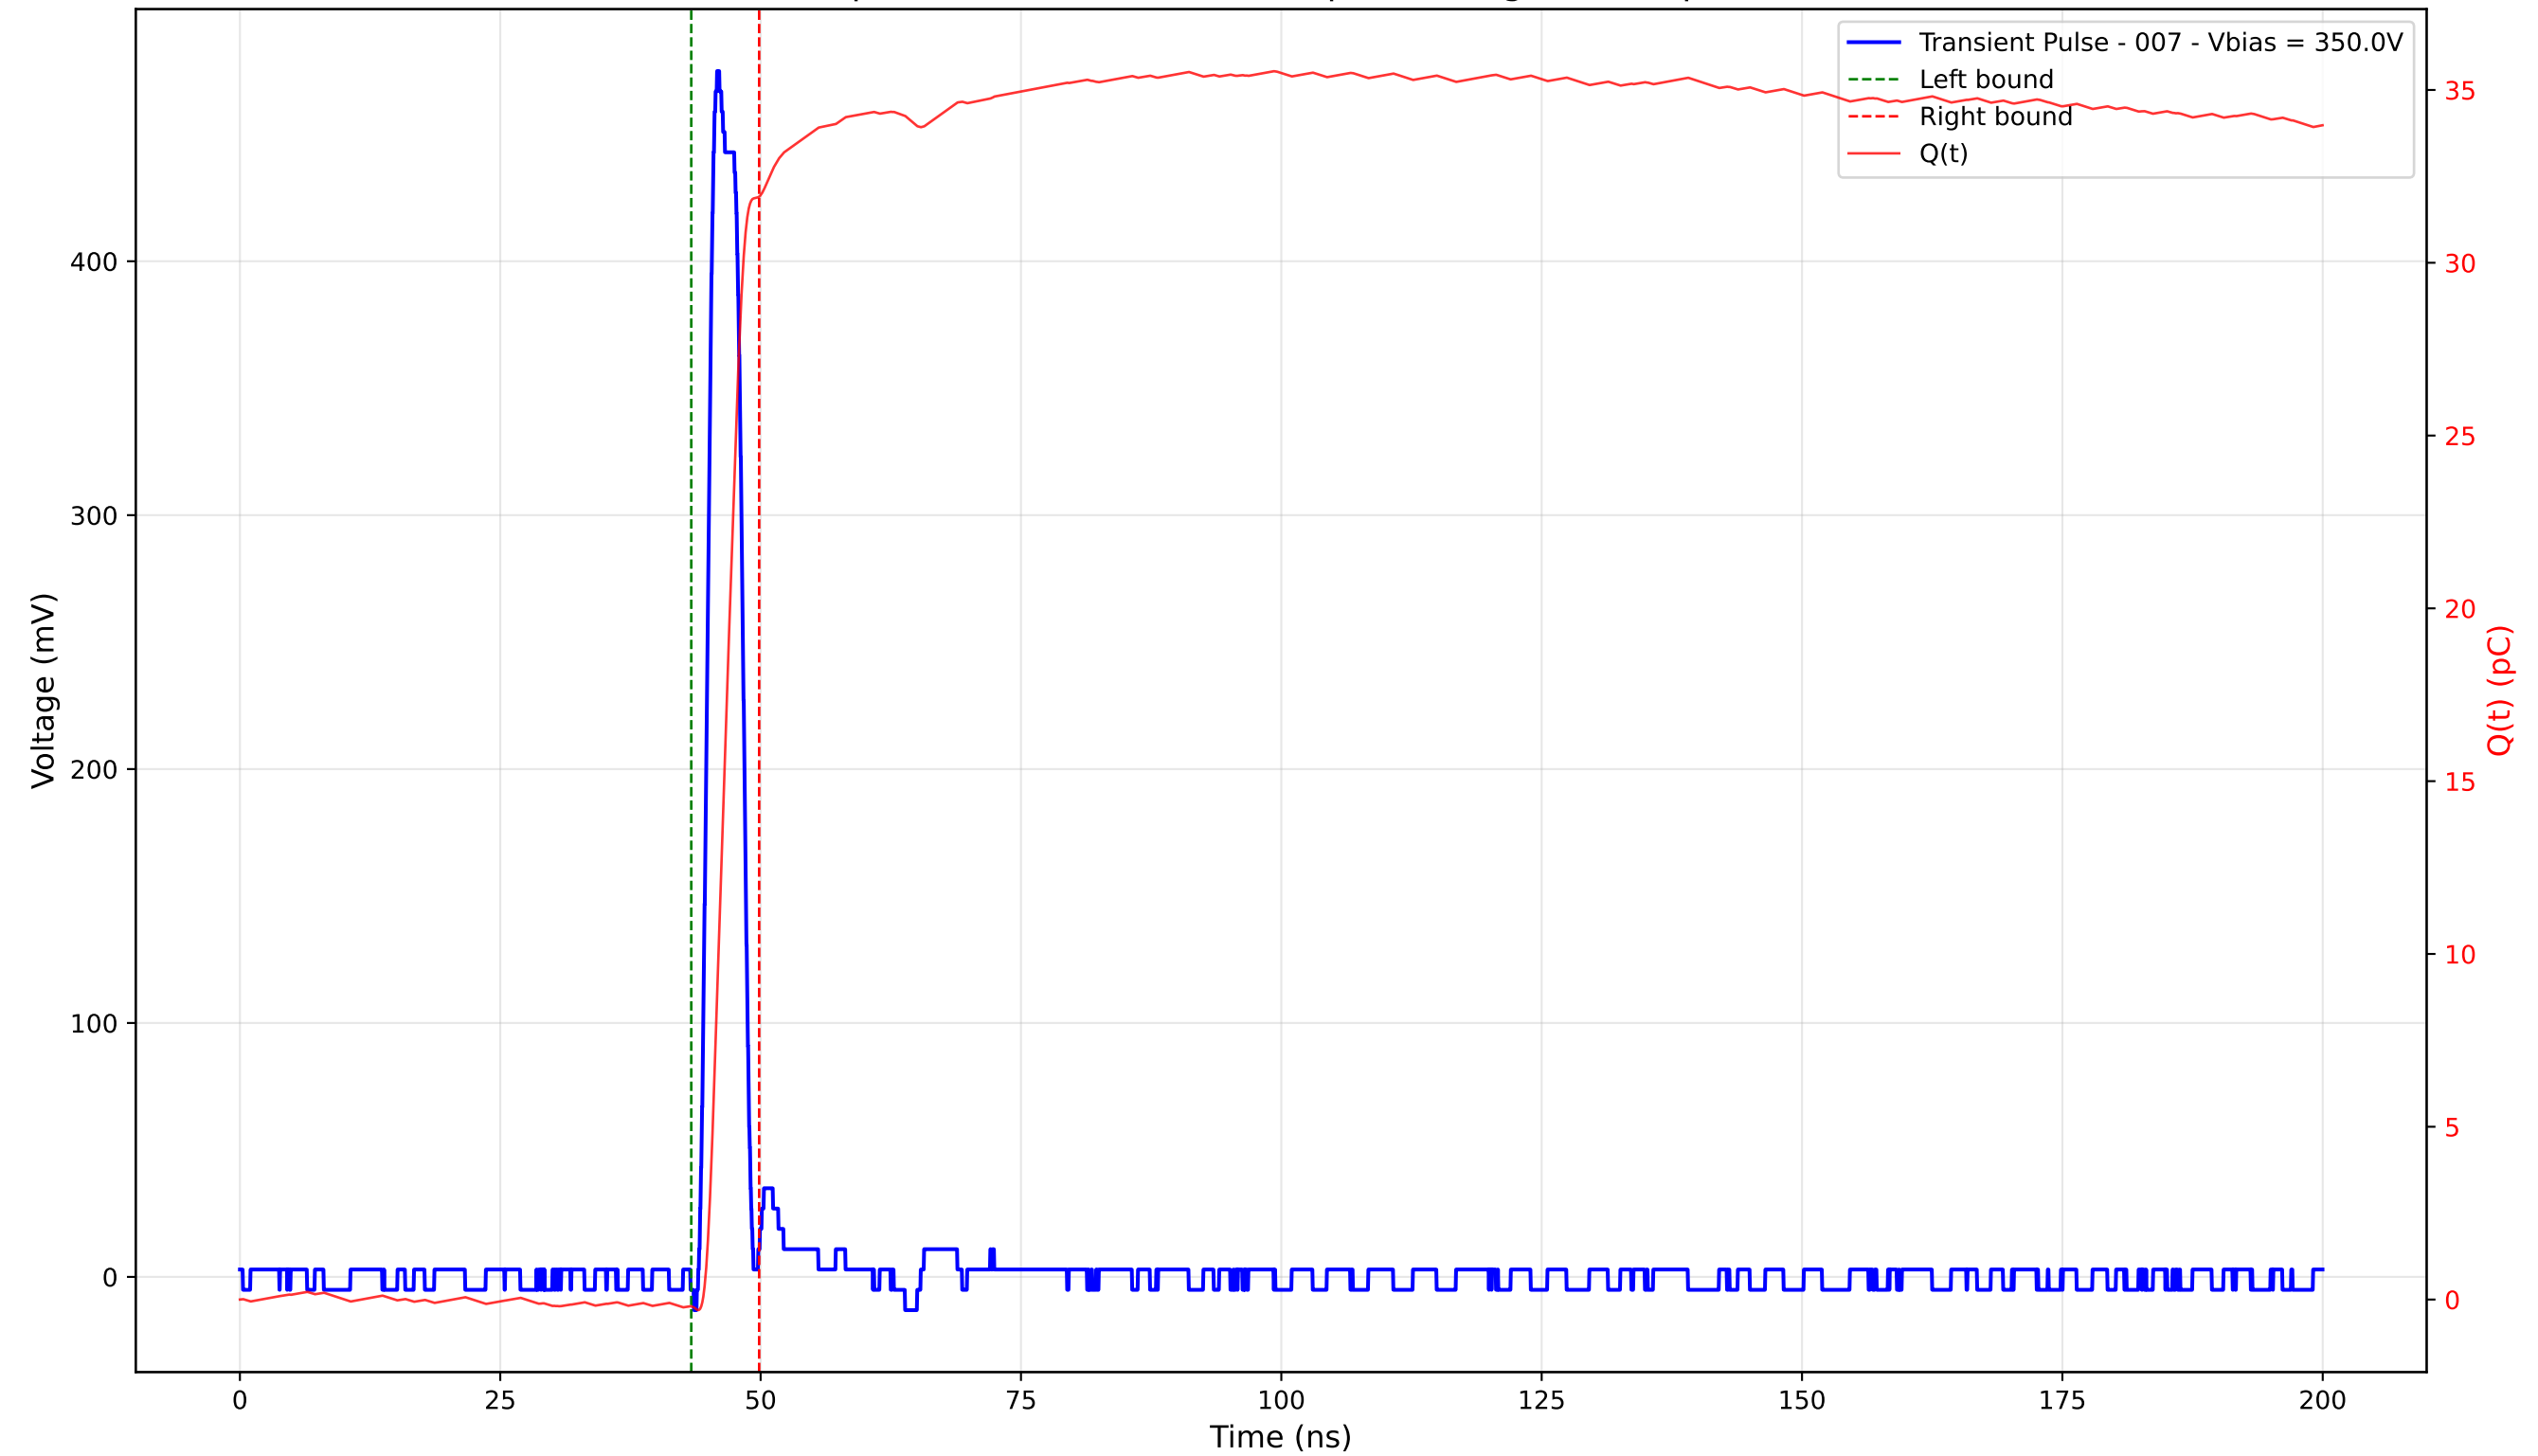


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 32.18 pC - Rise Time: 1.13 ns

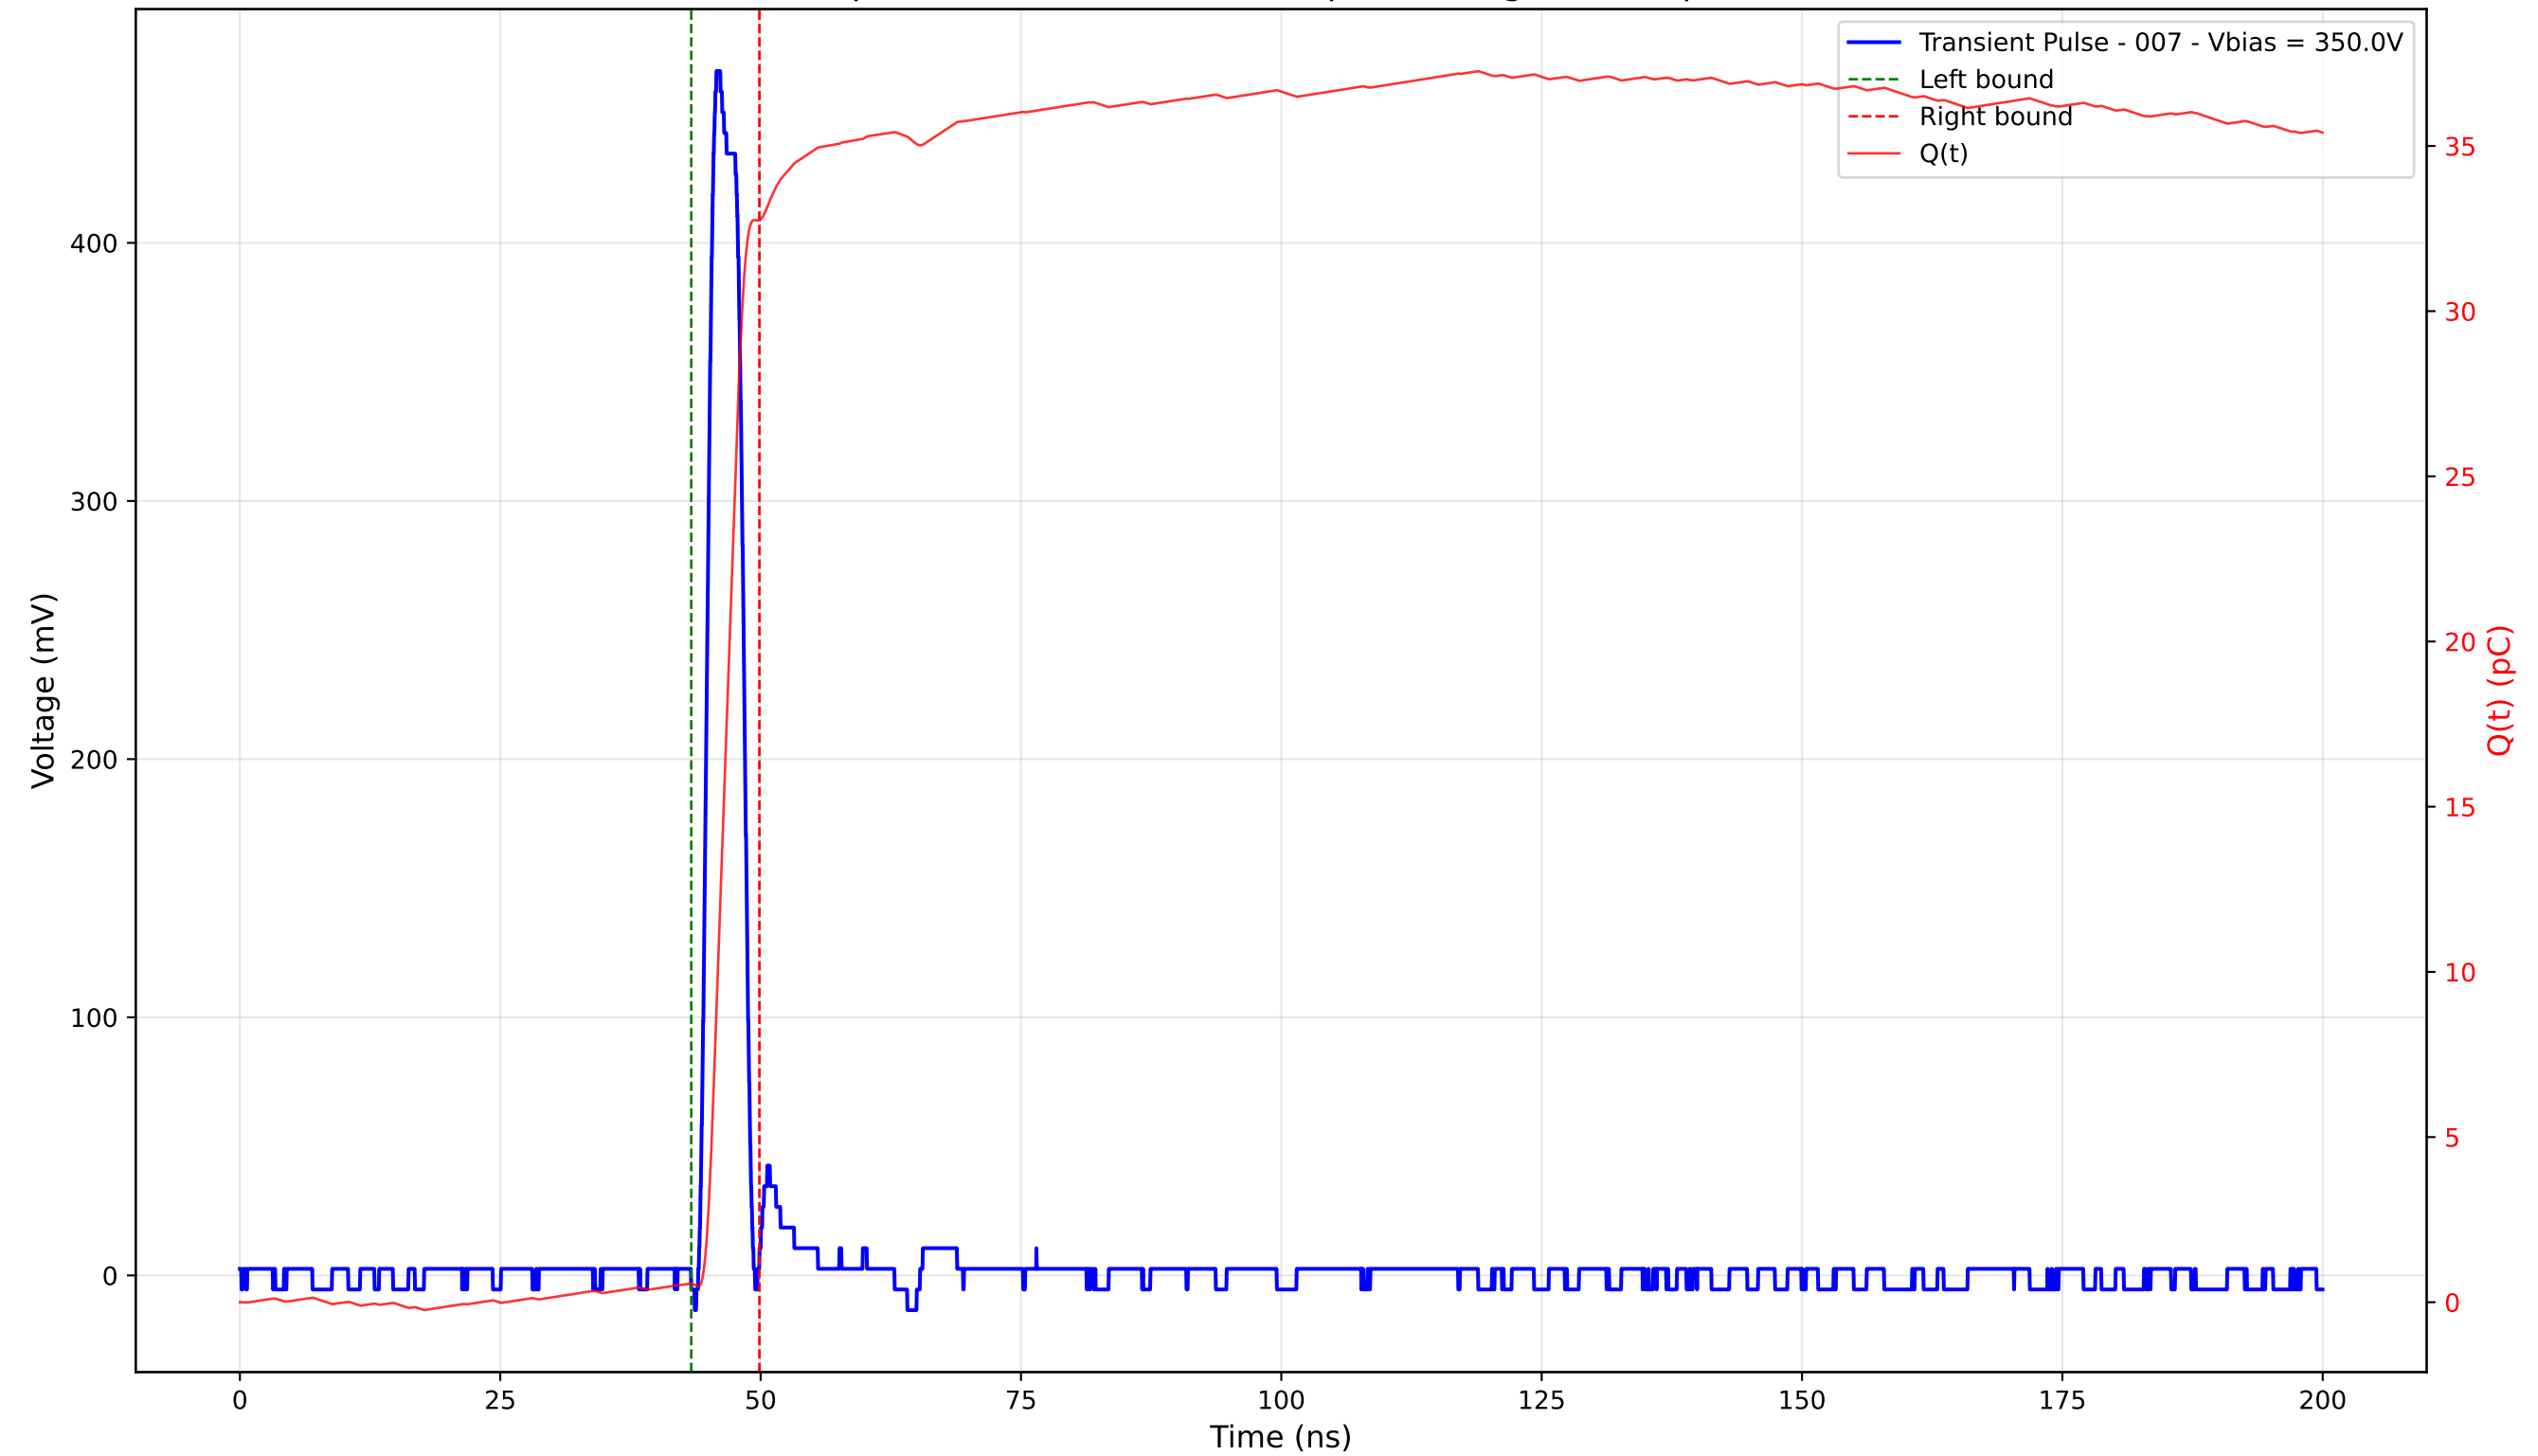


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 31.92 pC - Rise Time: 1.09 ns

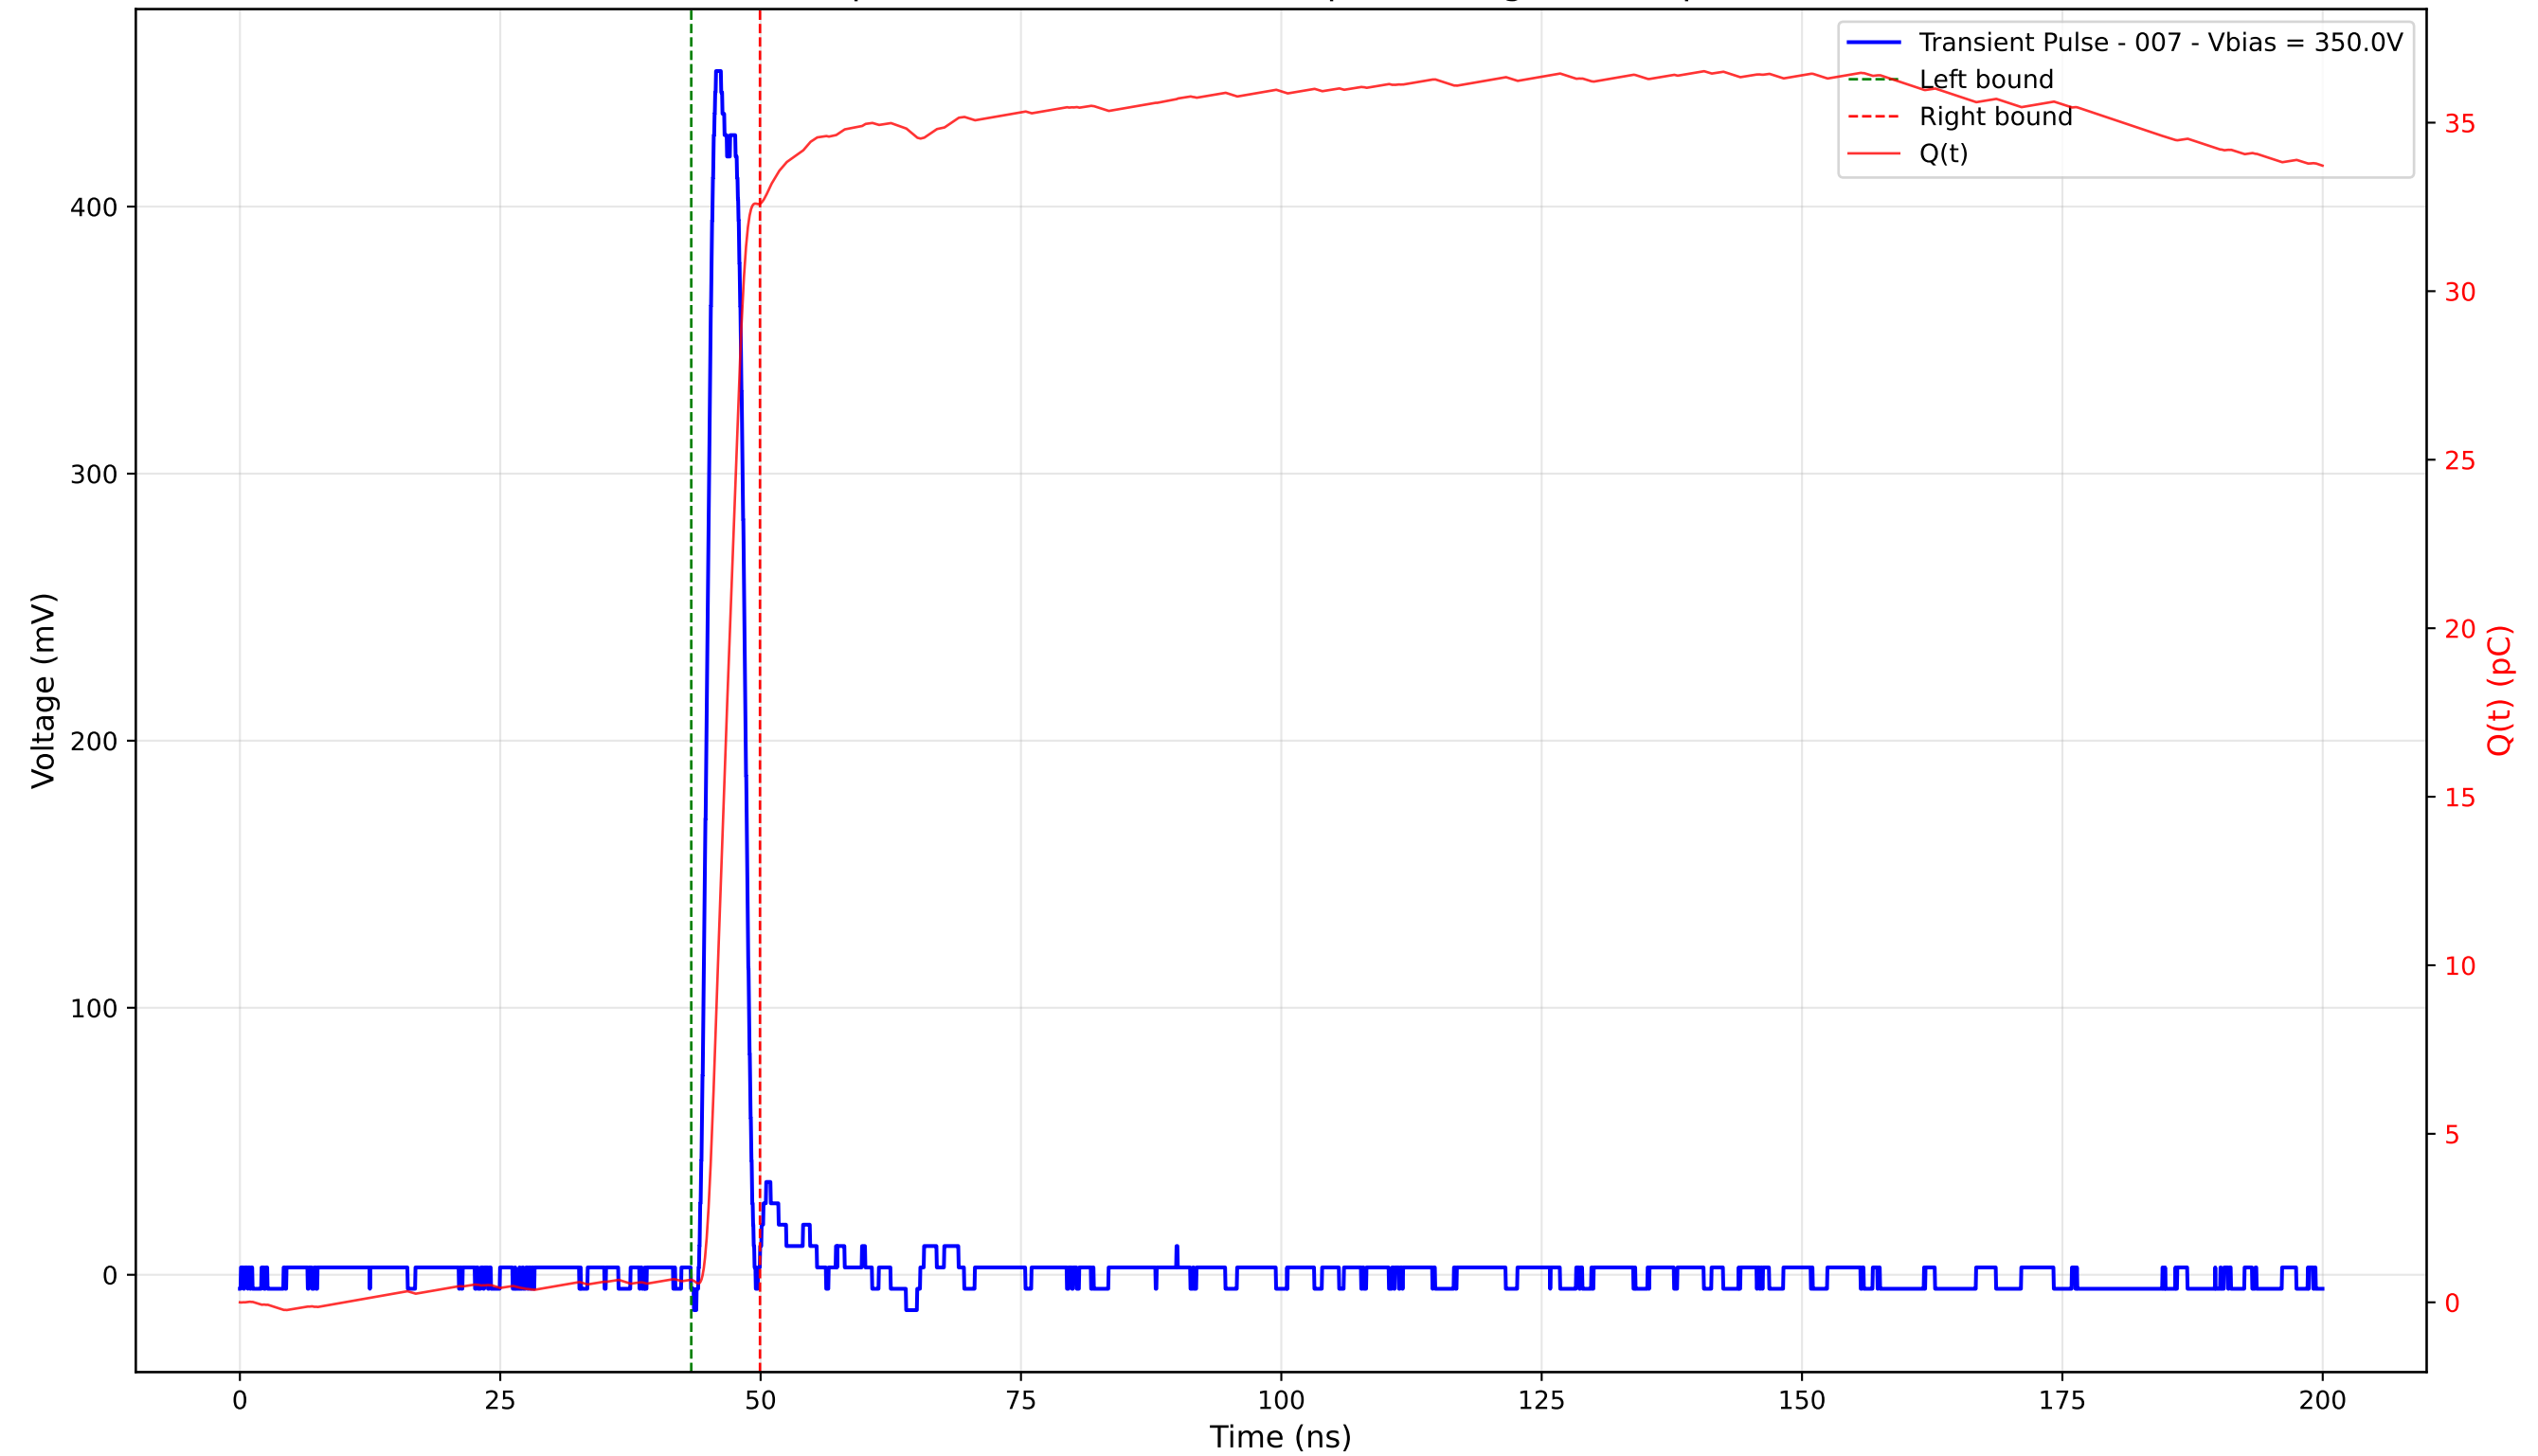


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 31.76 pC - Rise Time: 1.12 ns

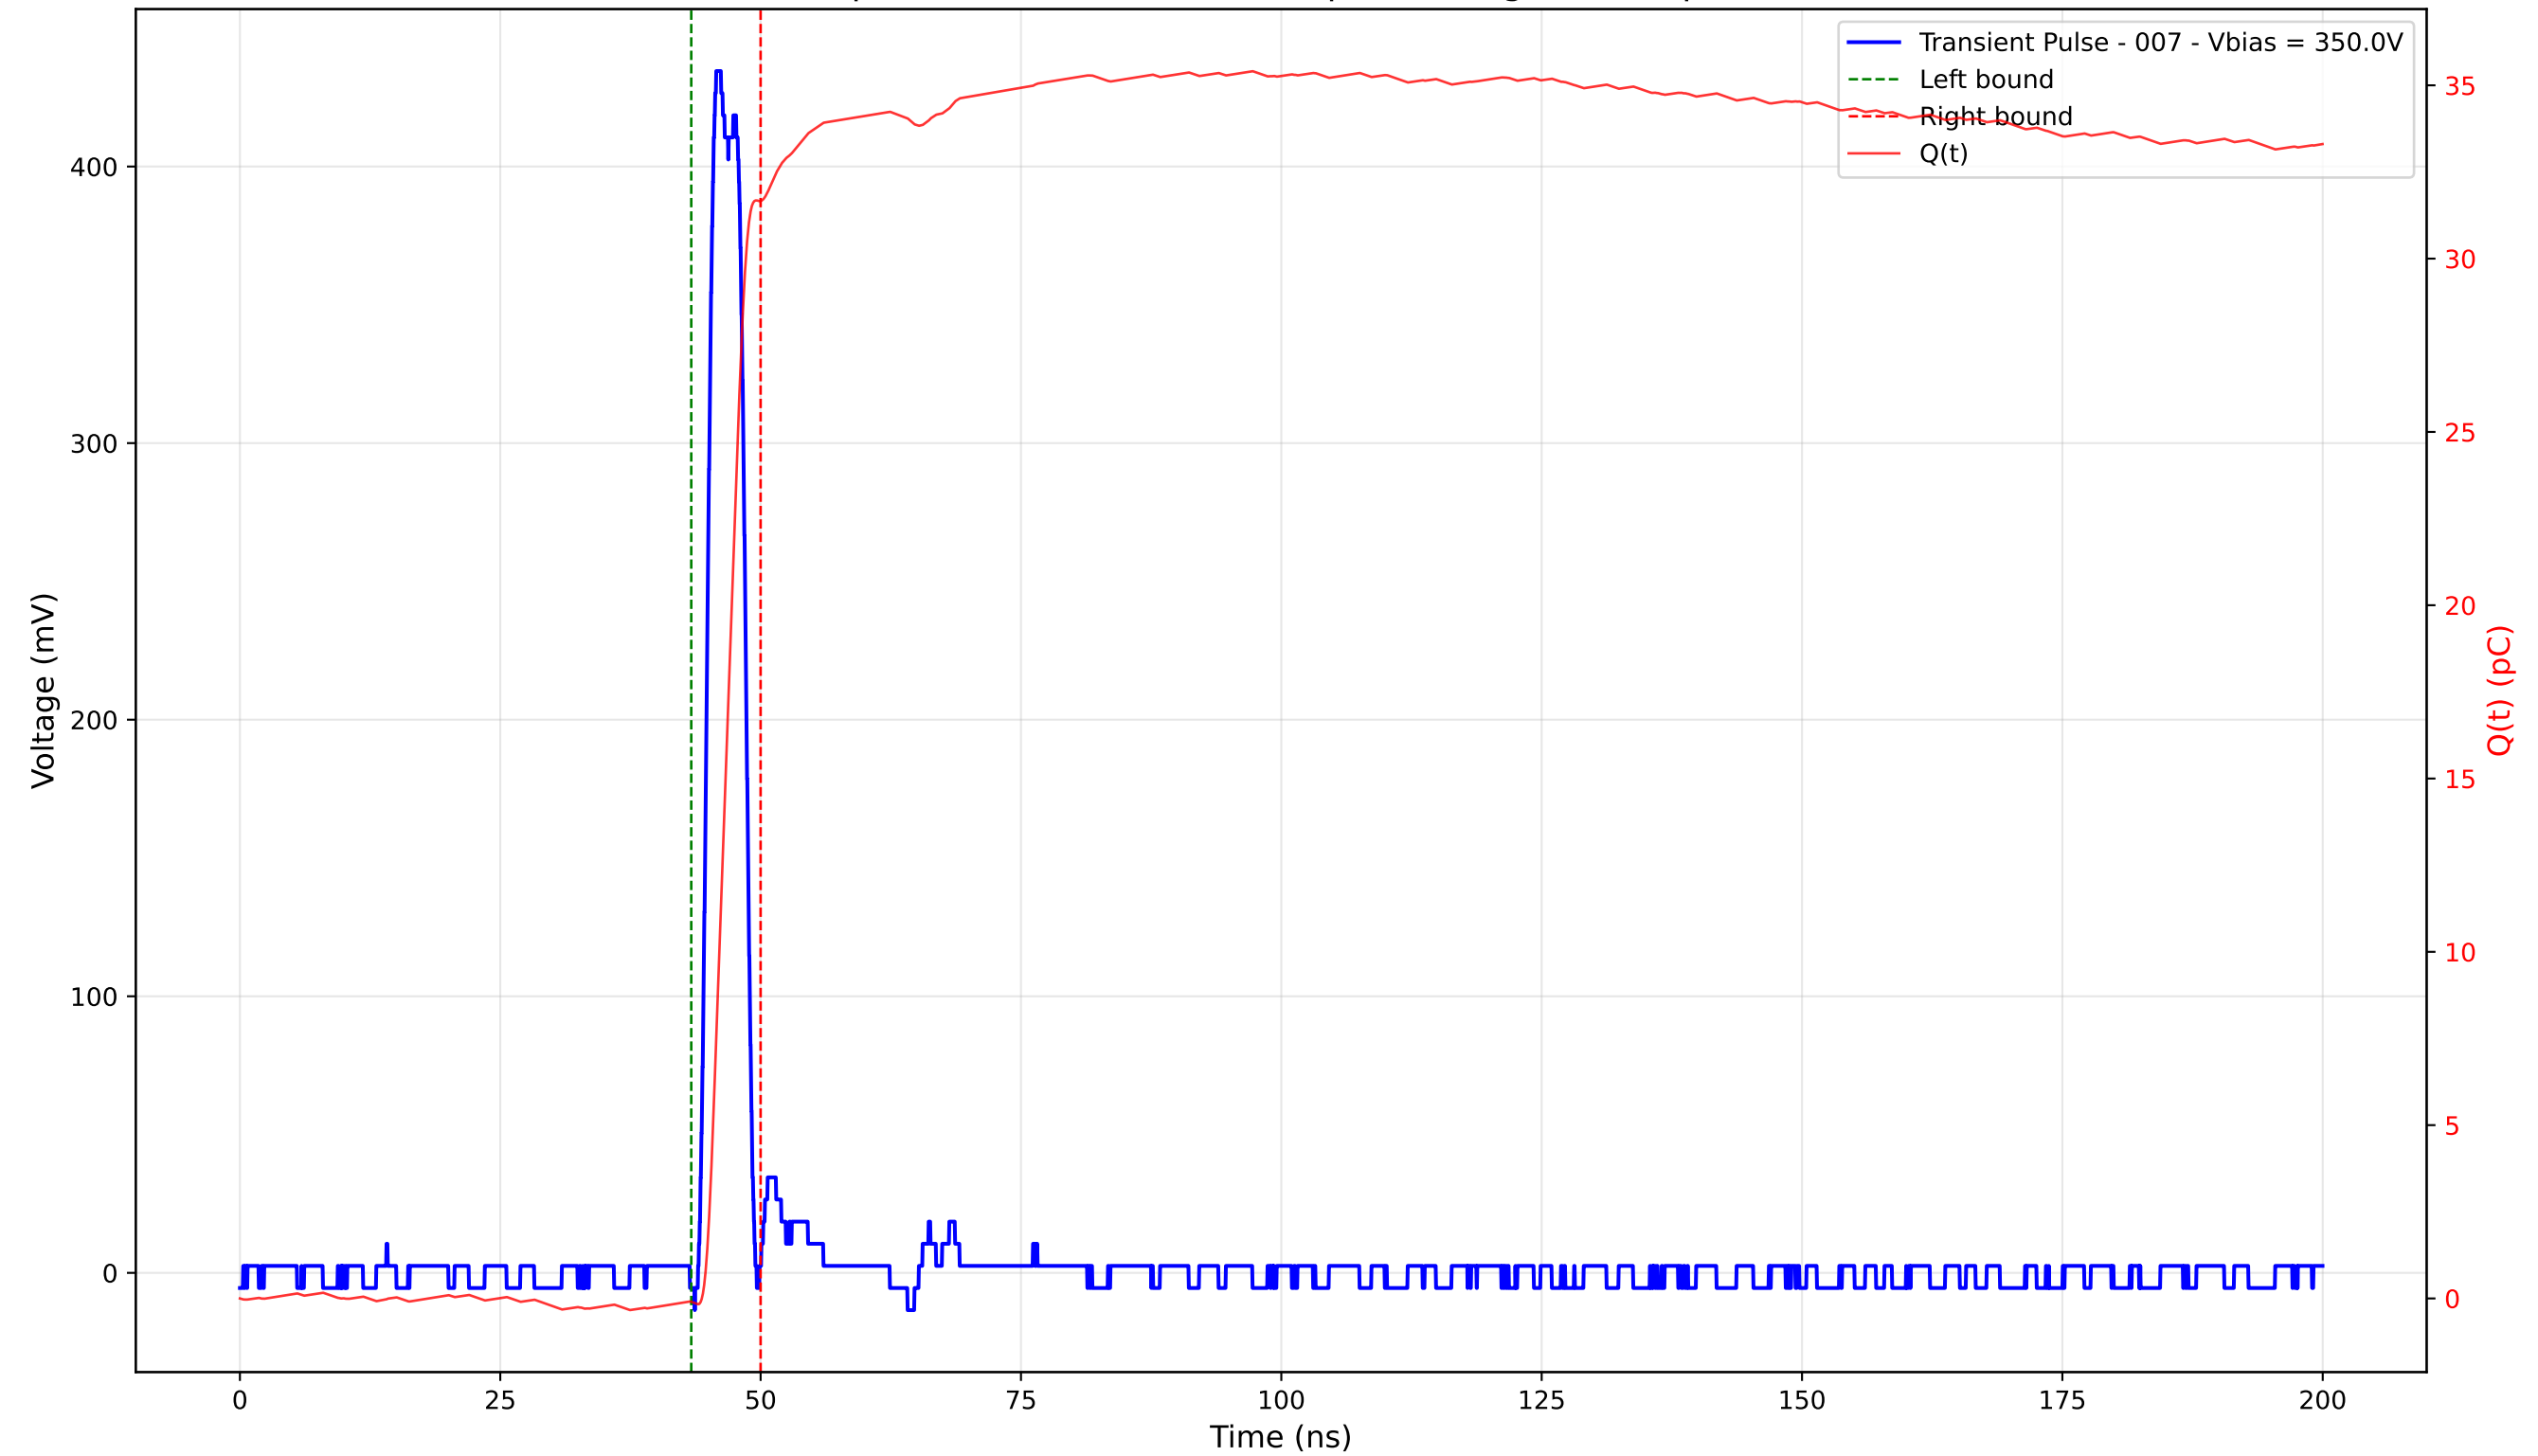


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 31.50 pC - Rise Time: 1.08 ns

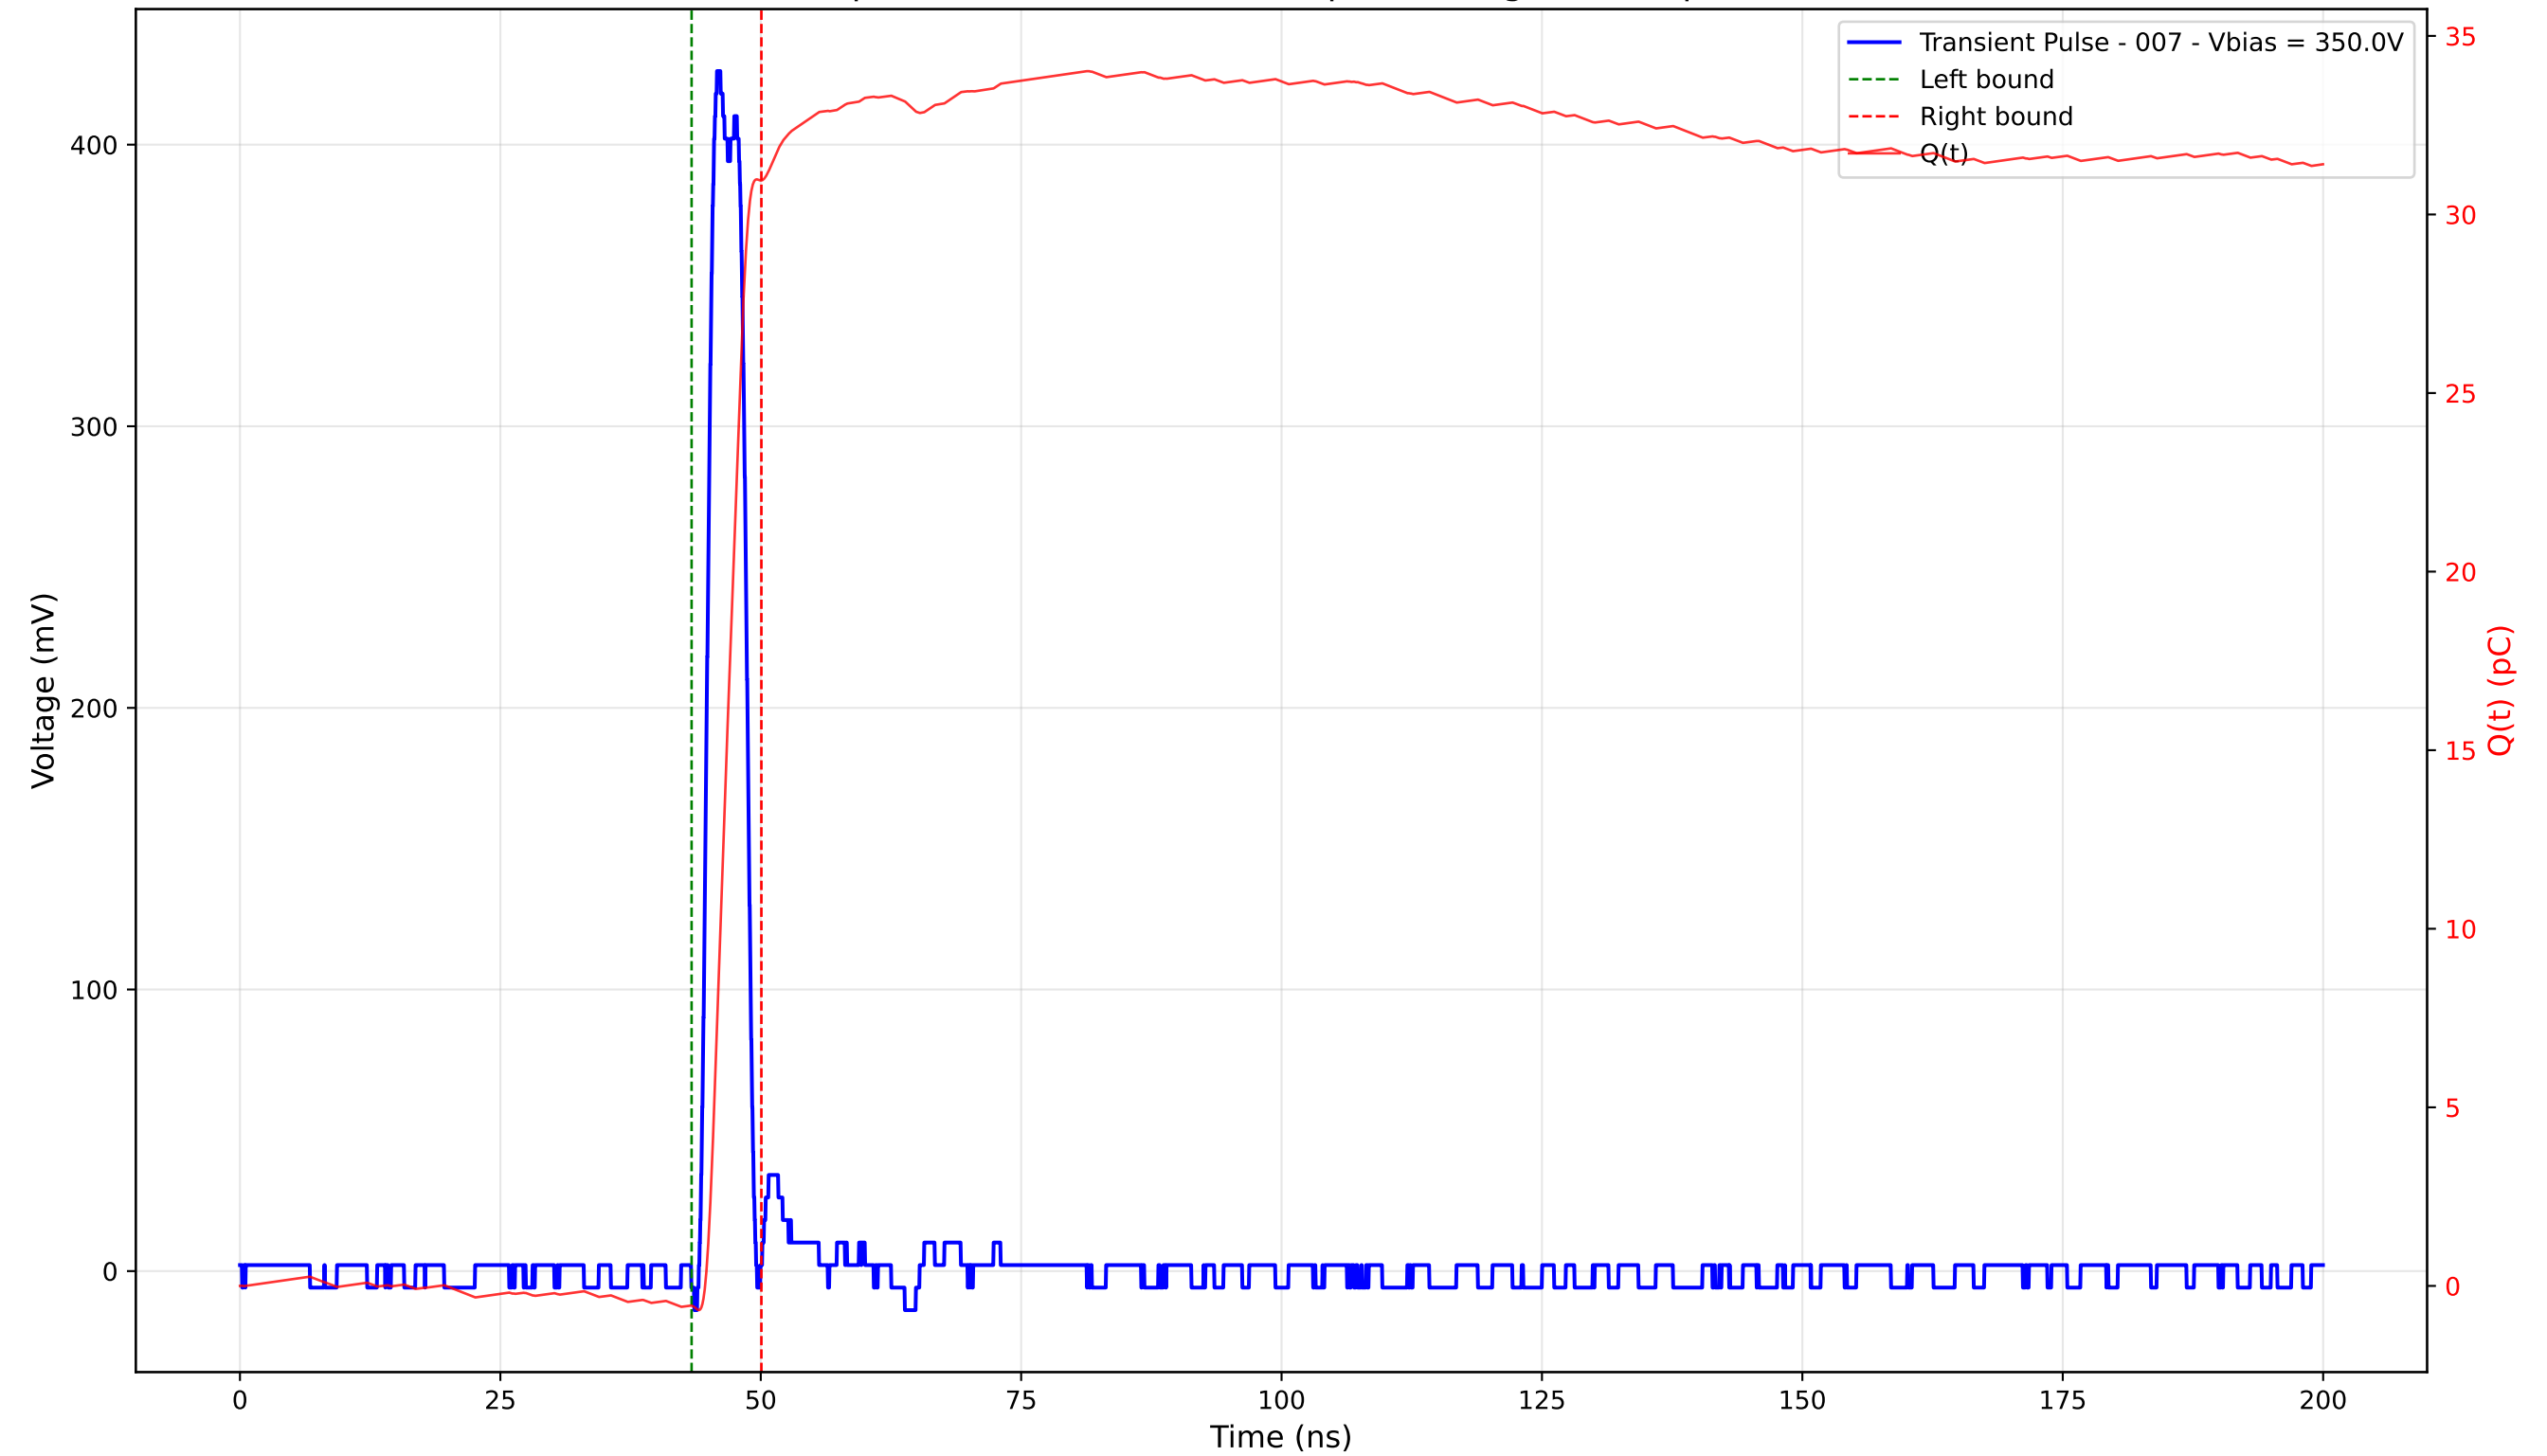


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 31.78 pC - Rise Time: 1.12 ns

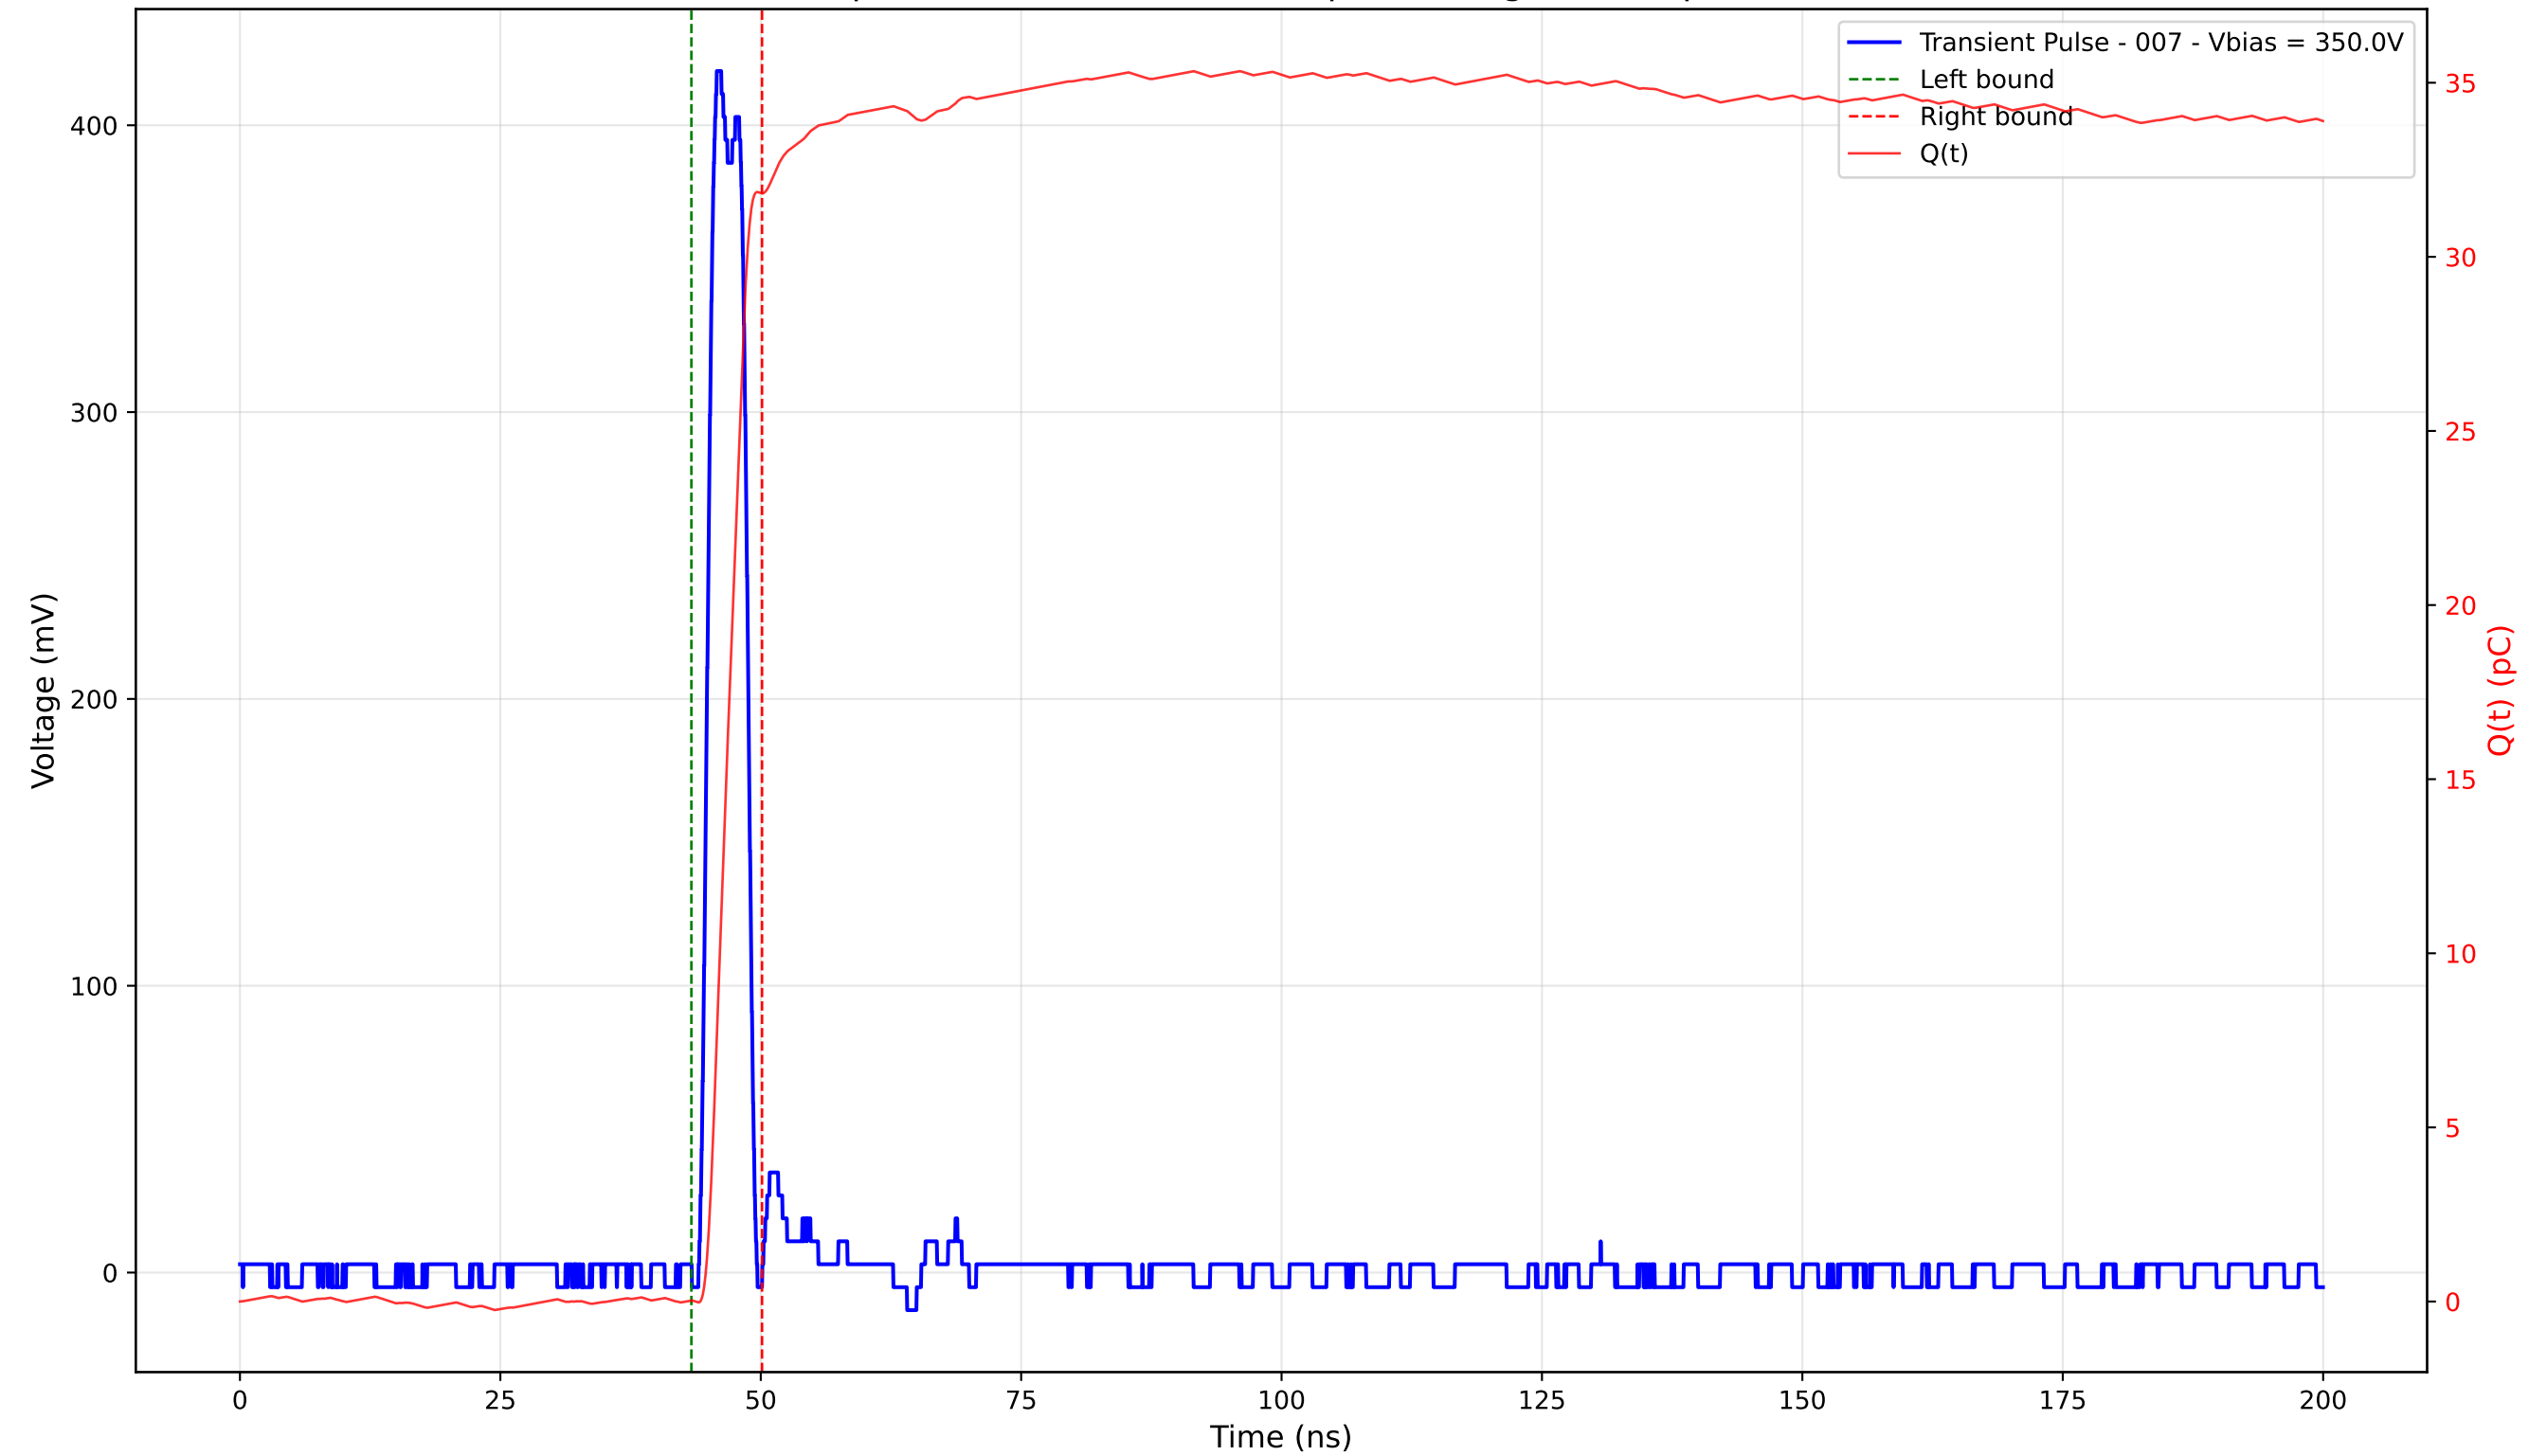


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 31.73 pC - Rise Time: 1.10 ns

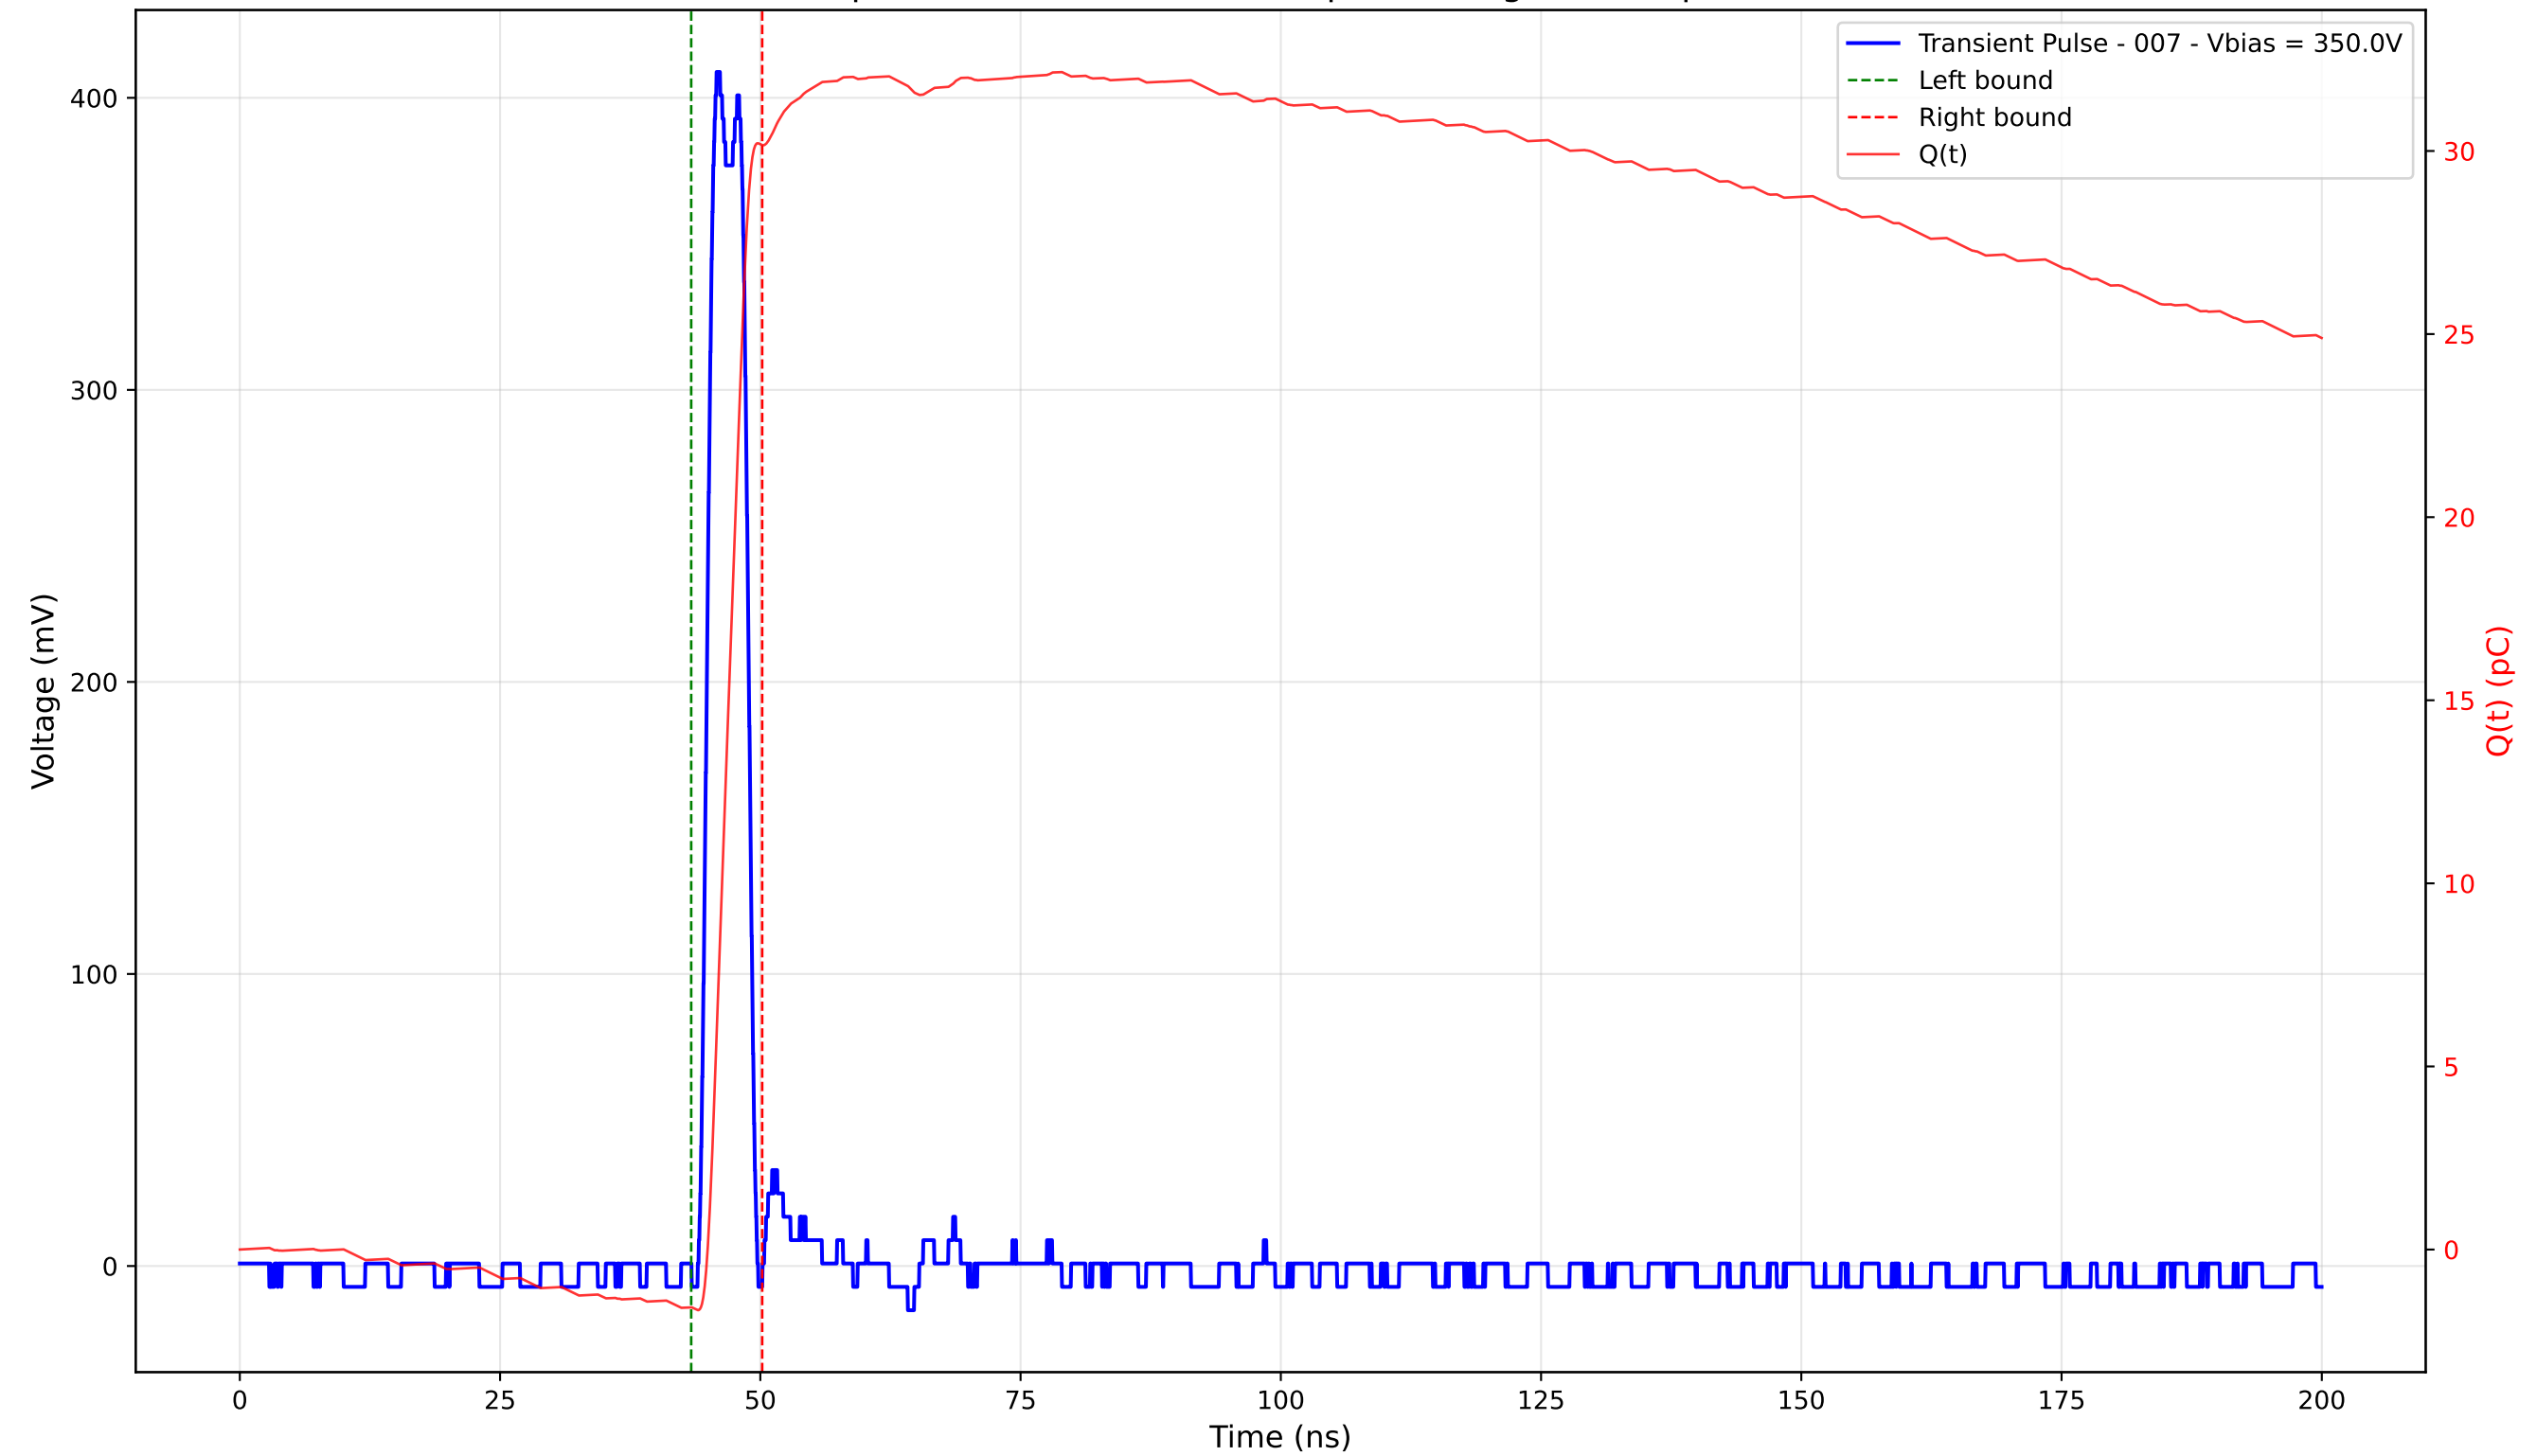


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 31.81 pC - Rise Time: 1.13 ns

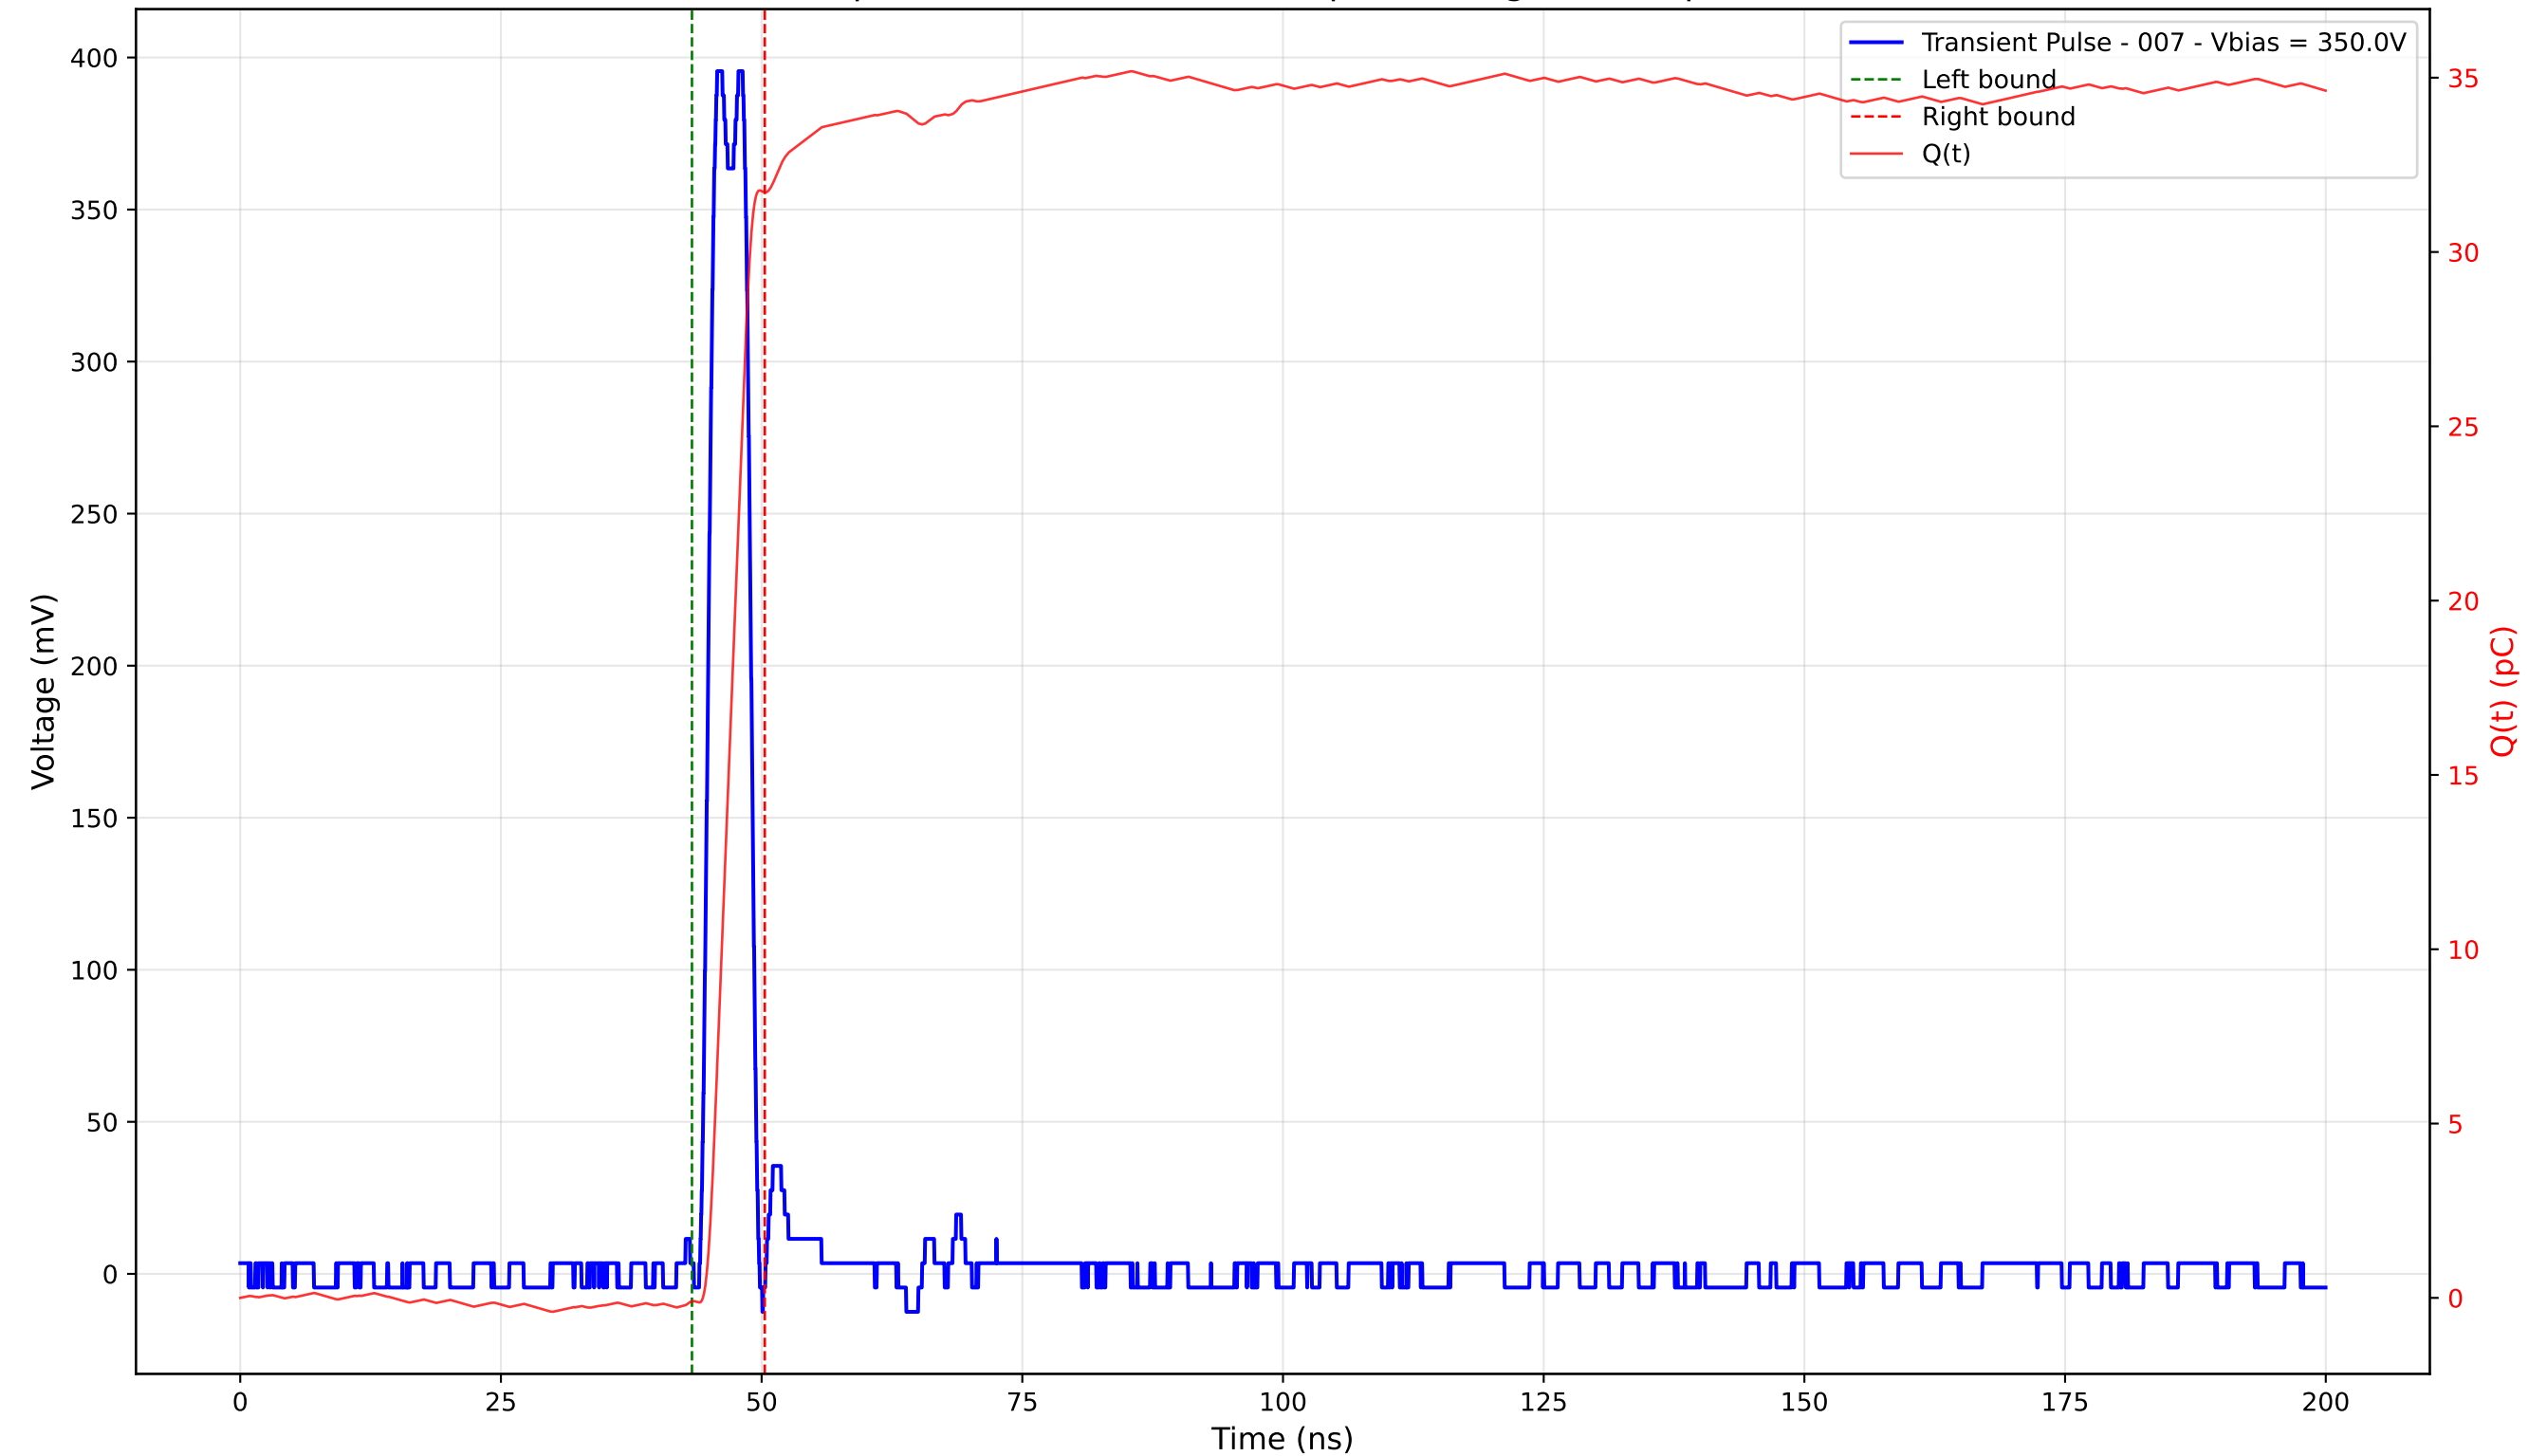


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 31.69 pC - Rise Time: 1.25 ns

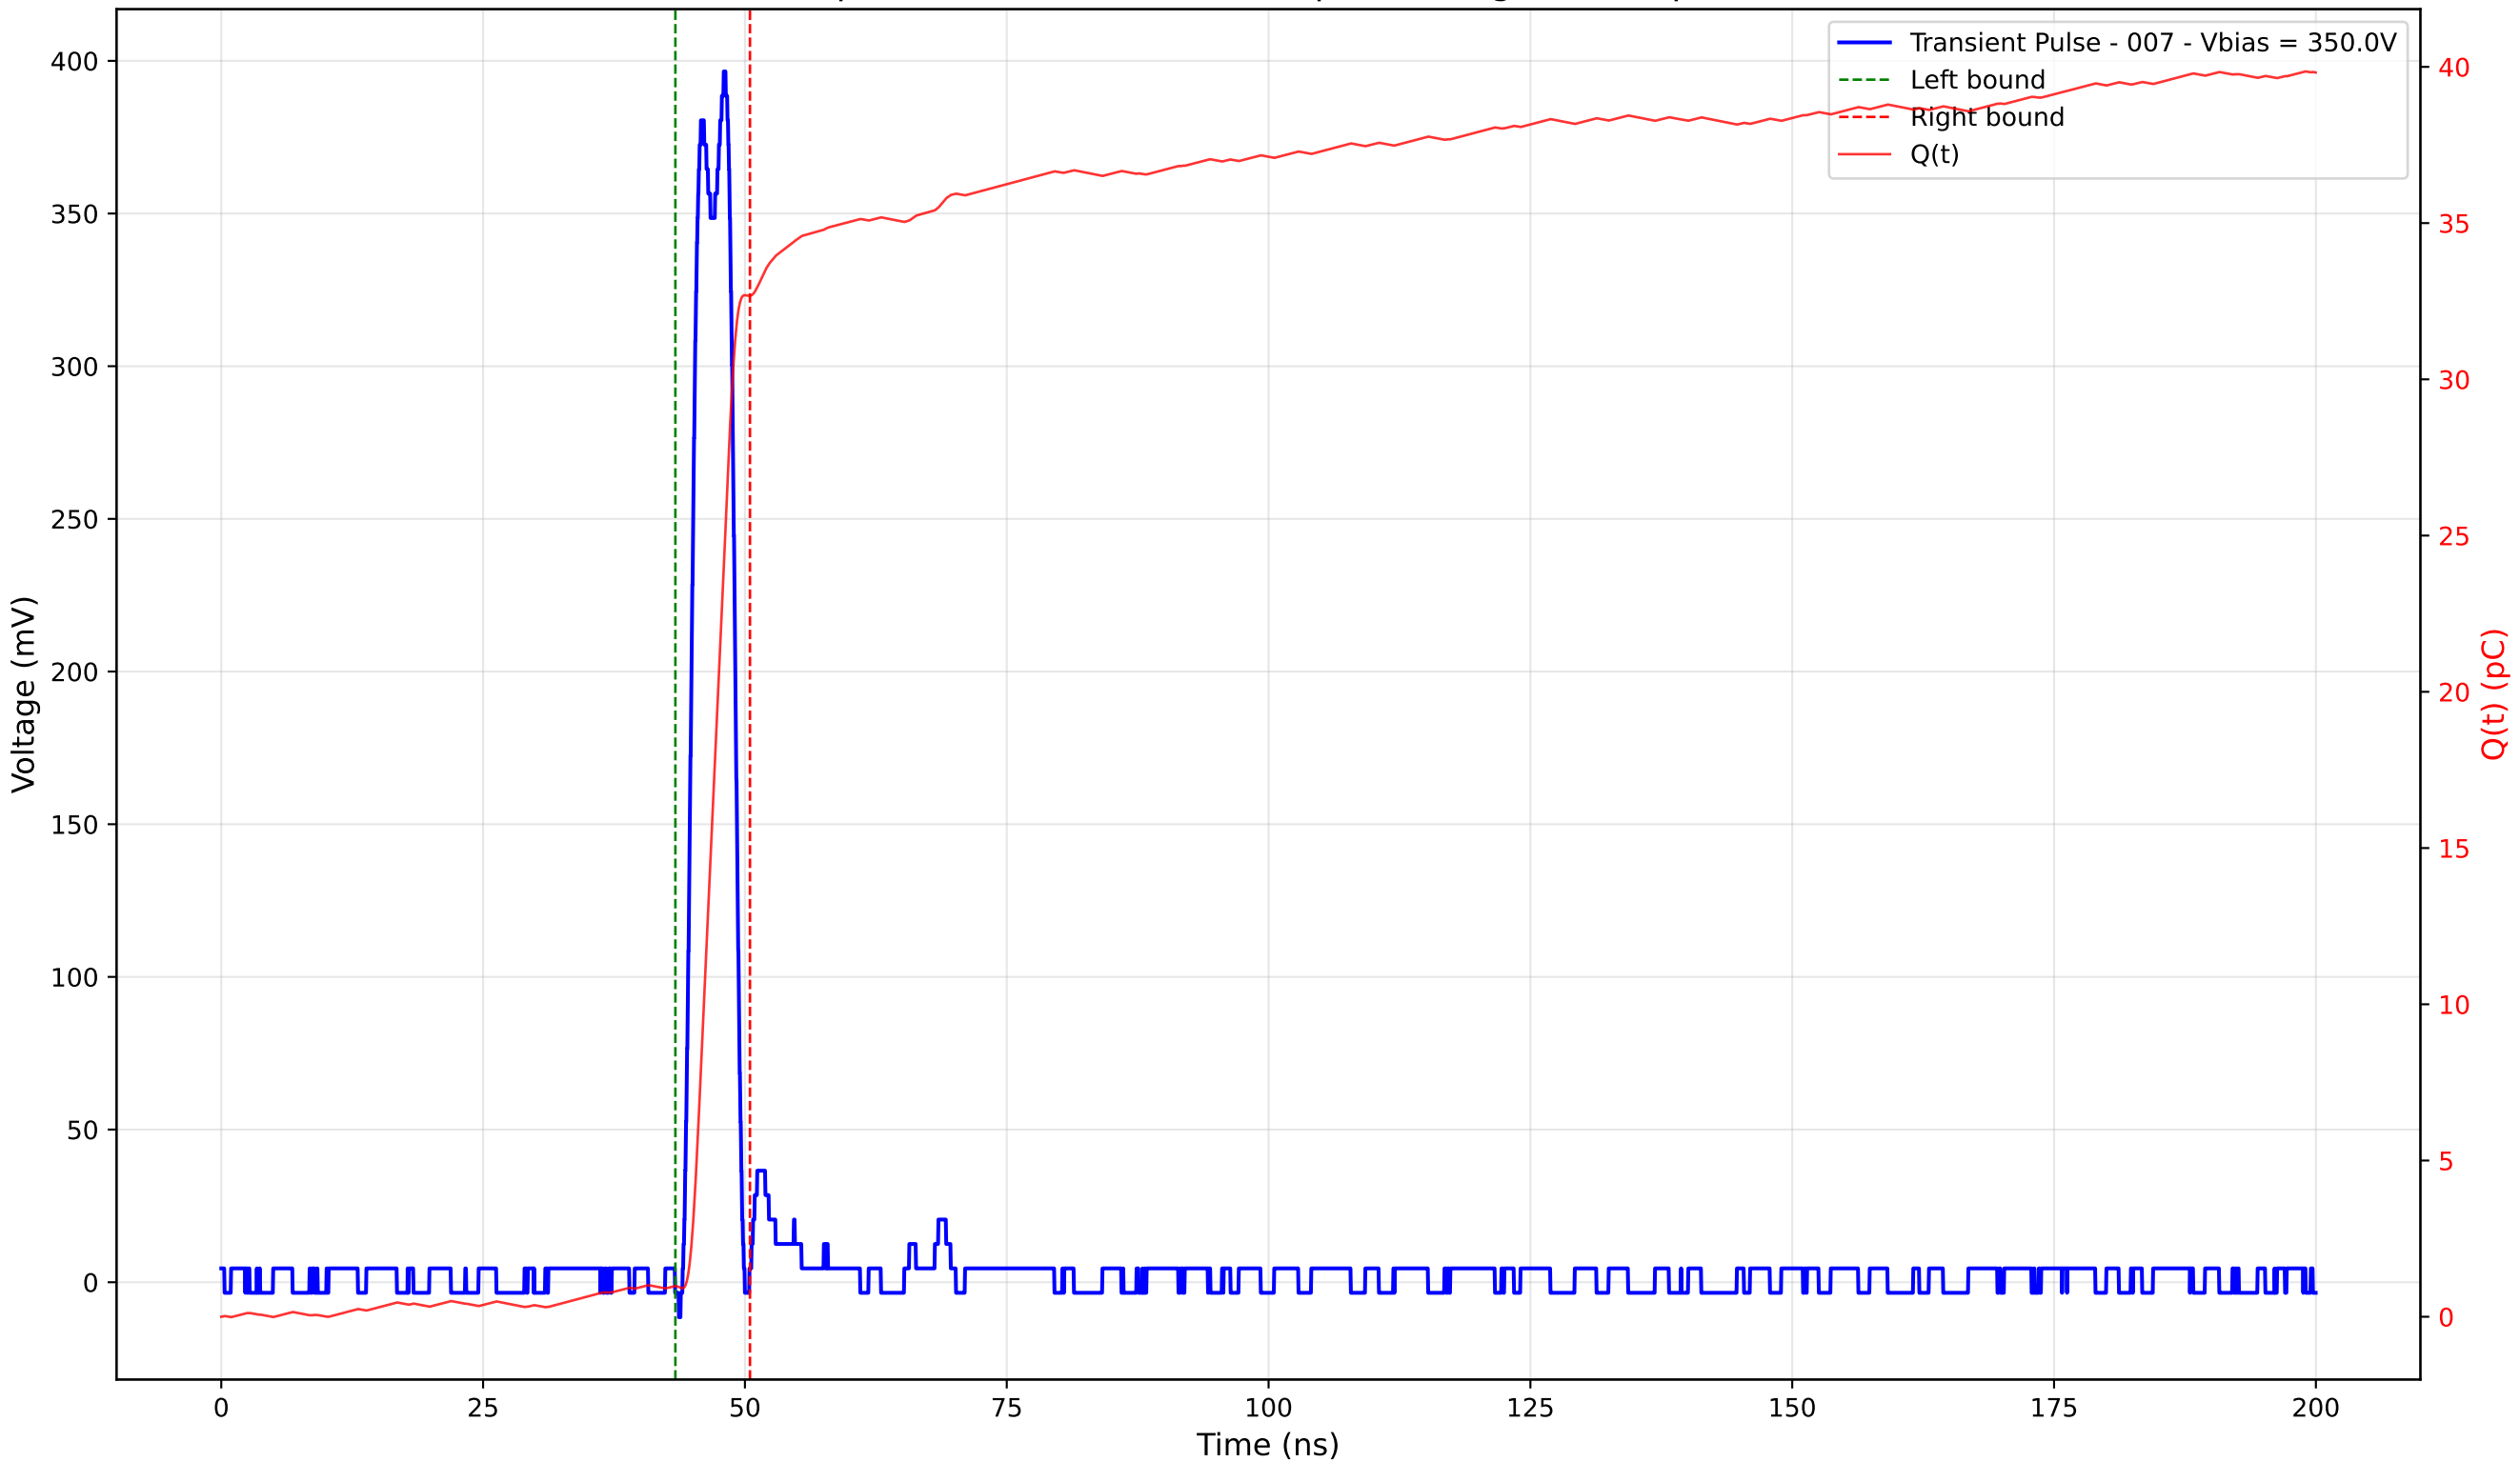


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 31.14 pC - Rise Time: 1.29 ns

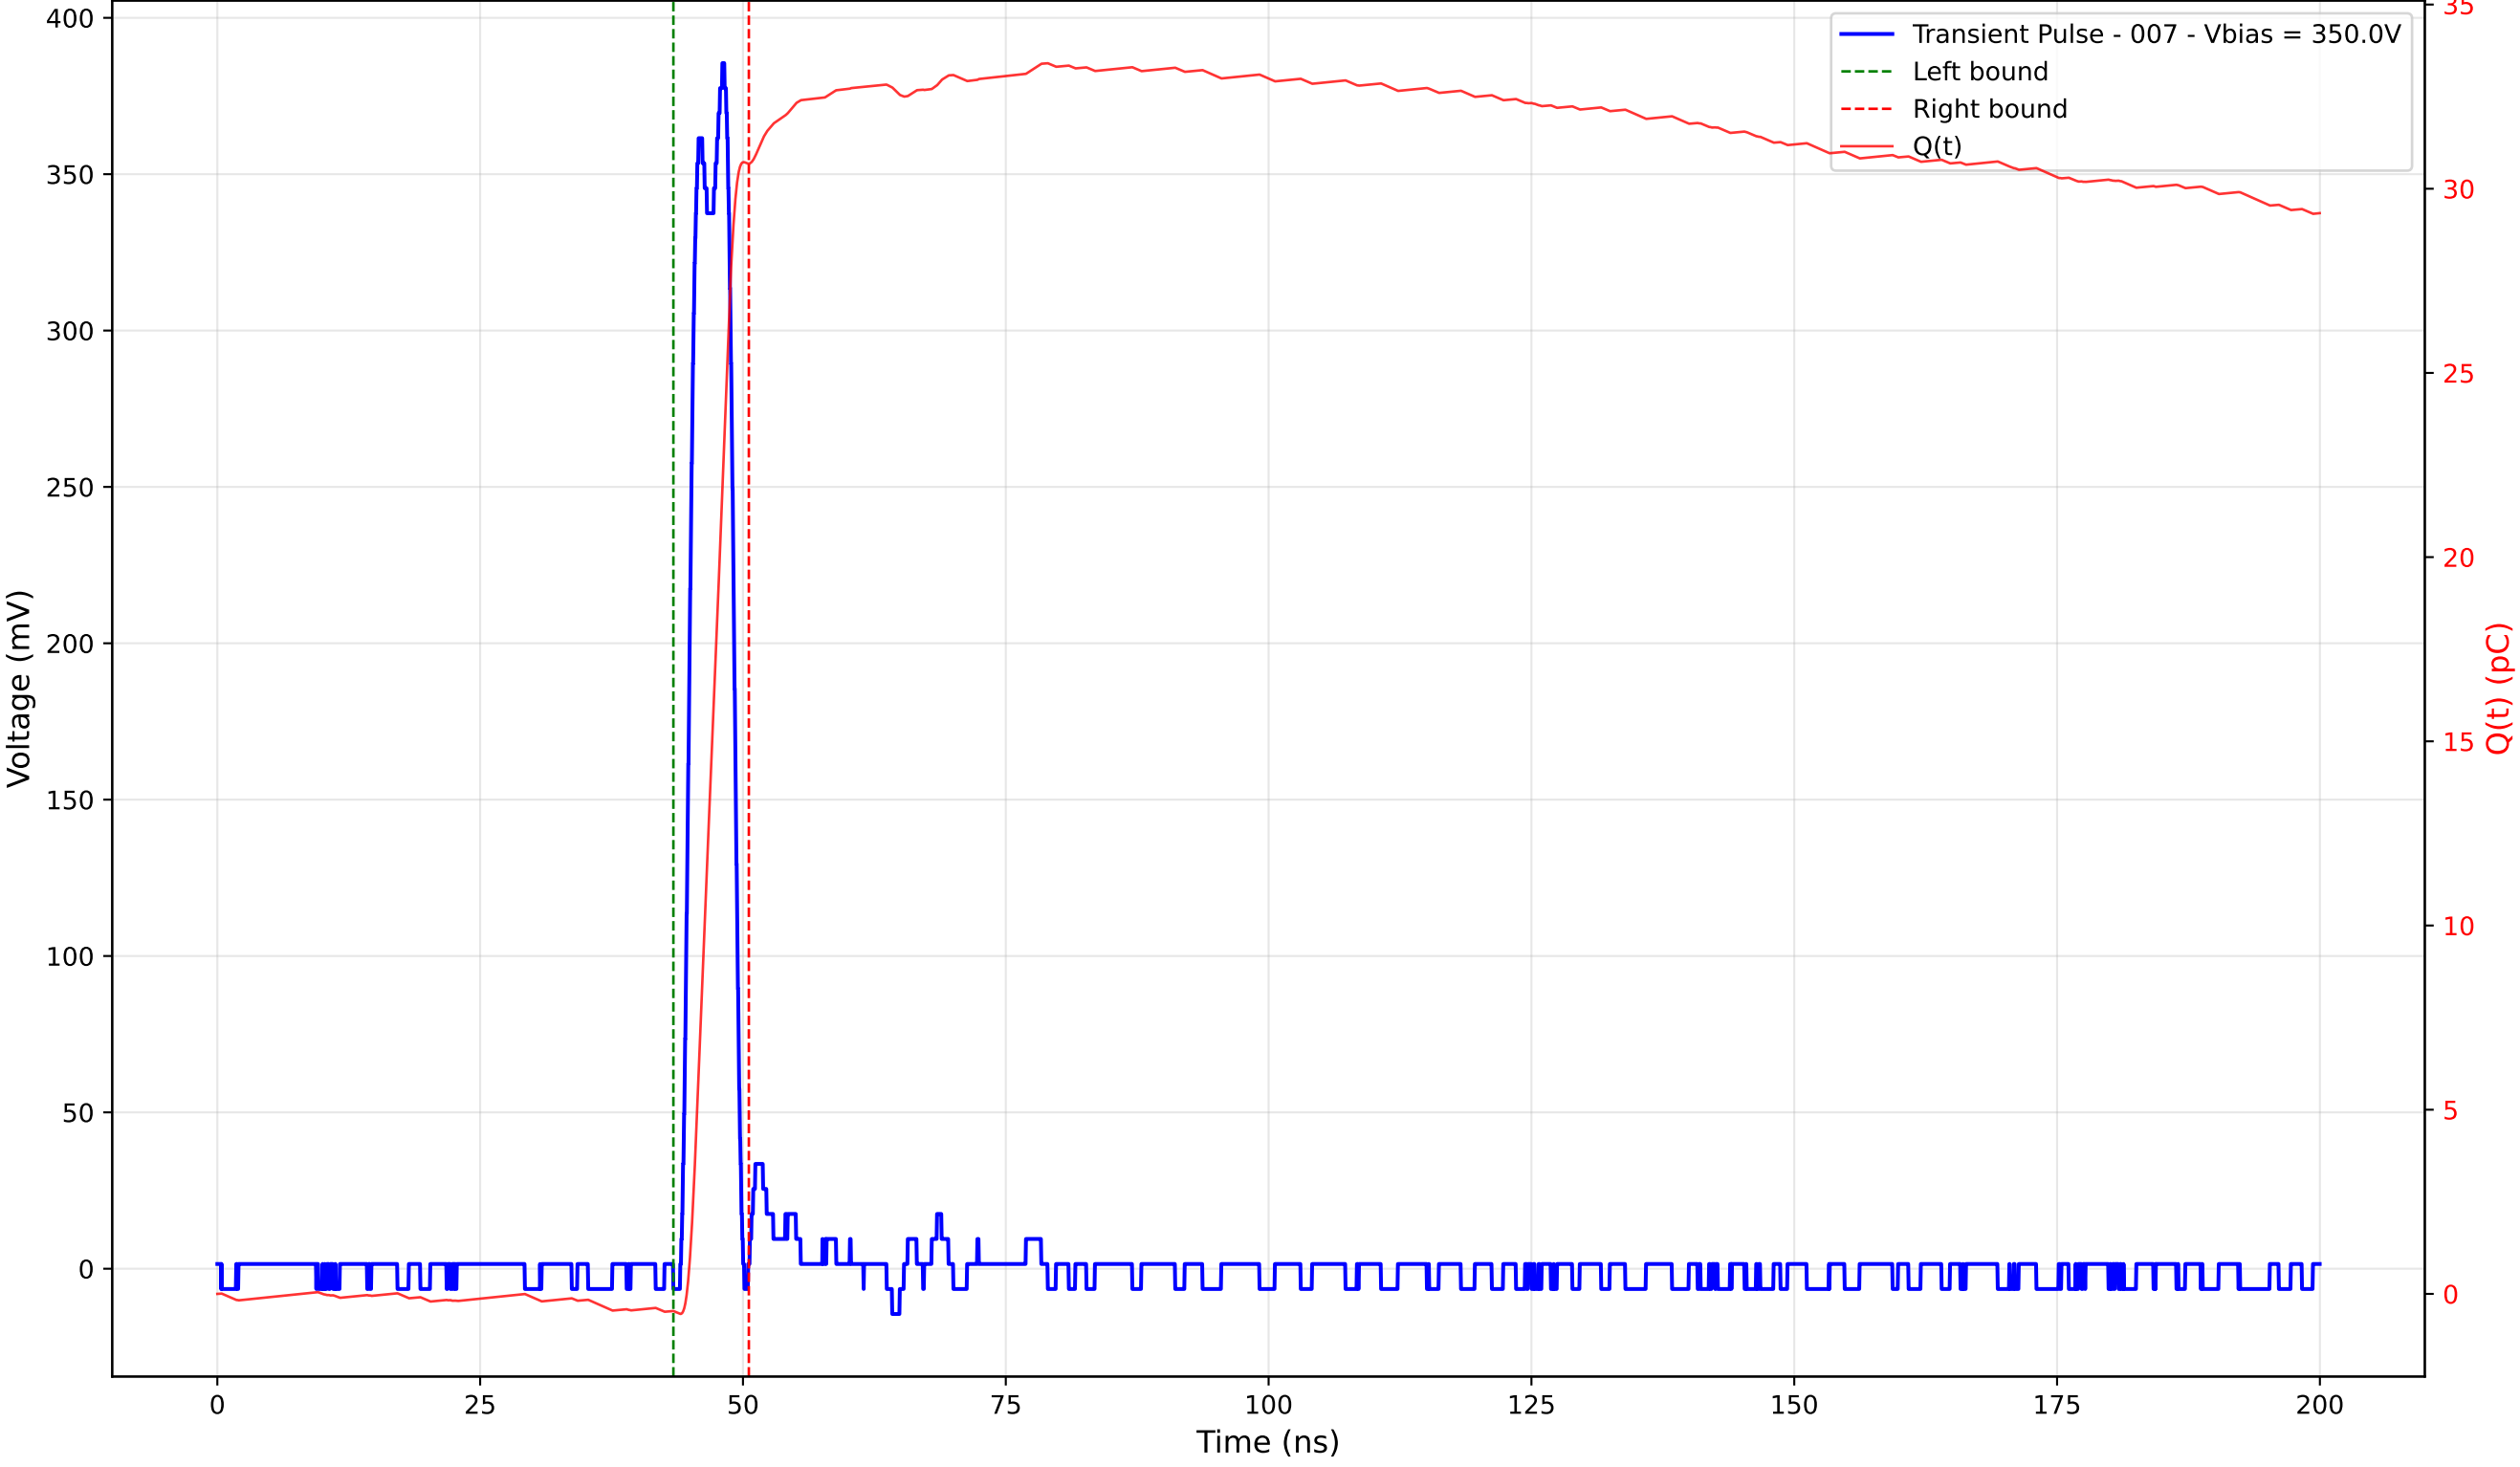


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 31.51 pC - Rise Time: 1.42 ns

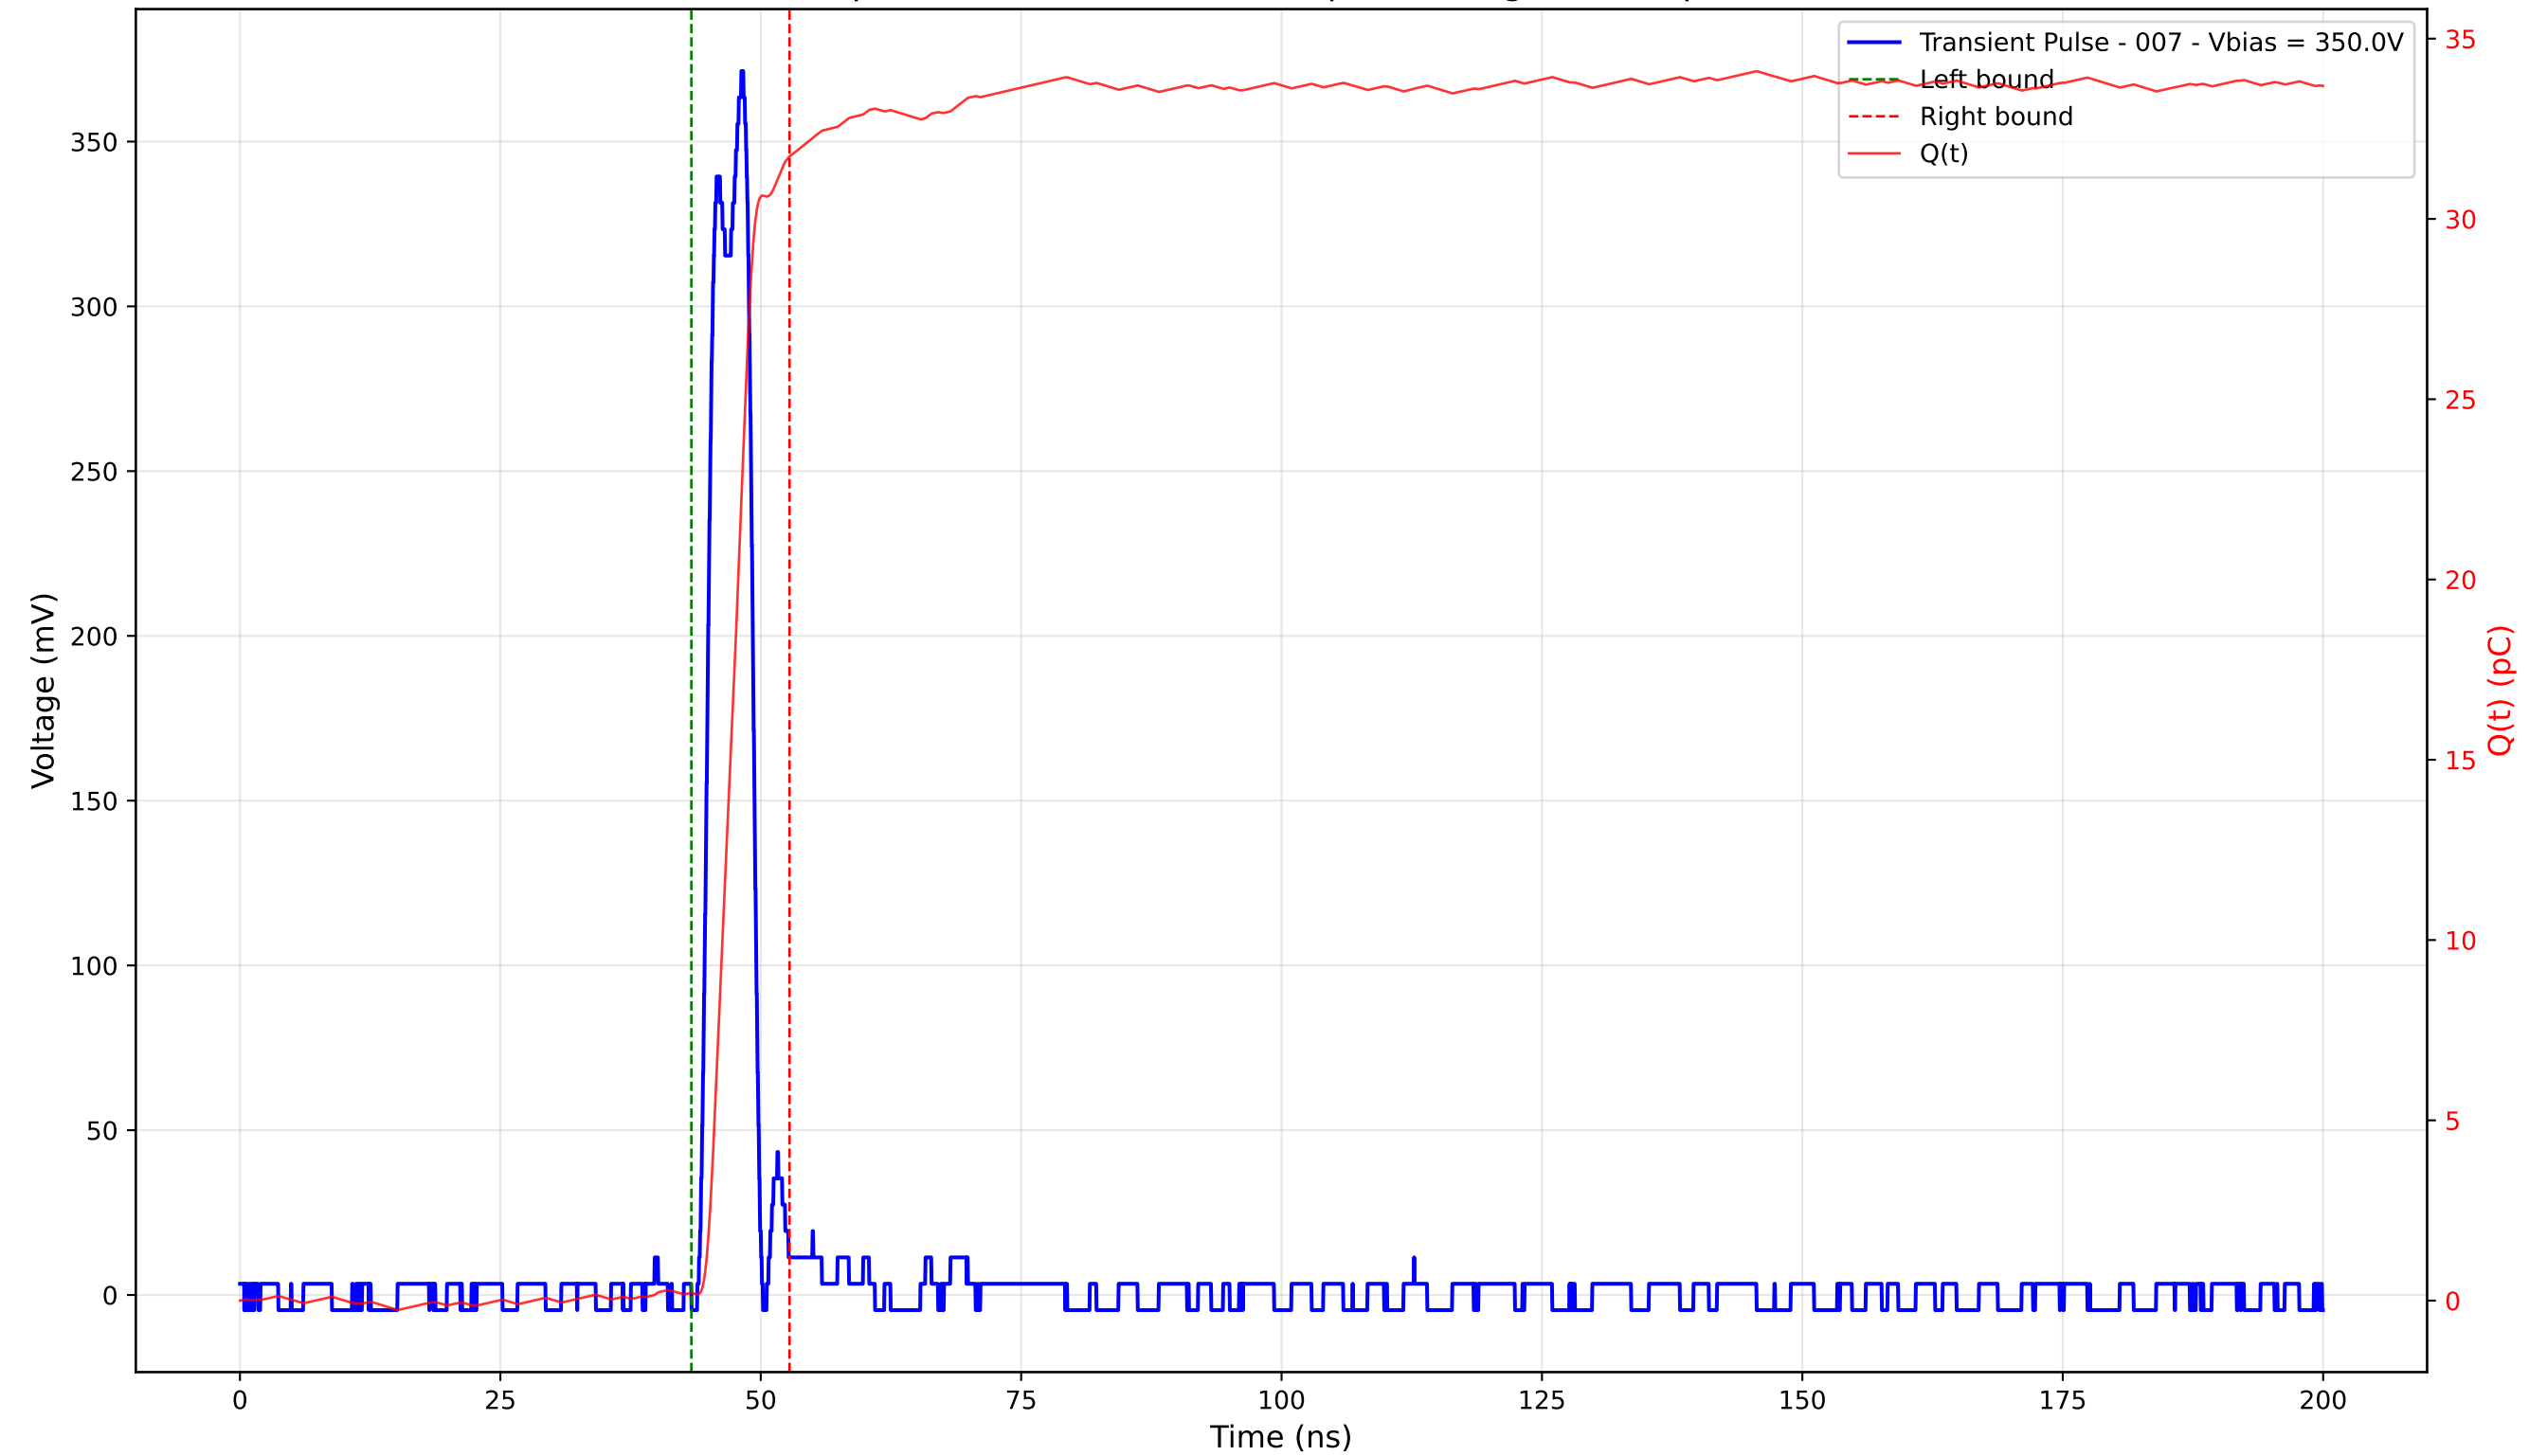


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 30.26 pC - Rise Time: 1.16 ns

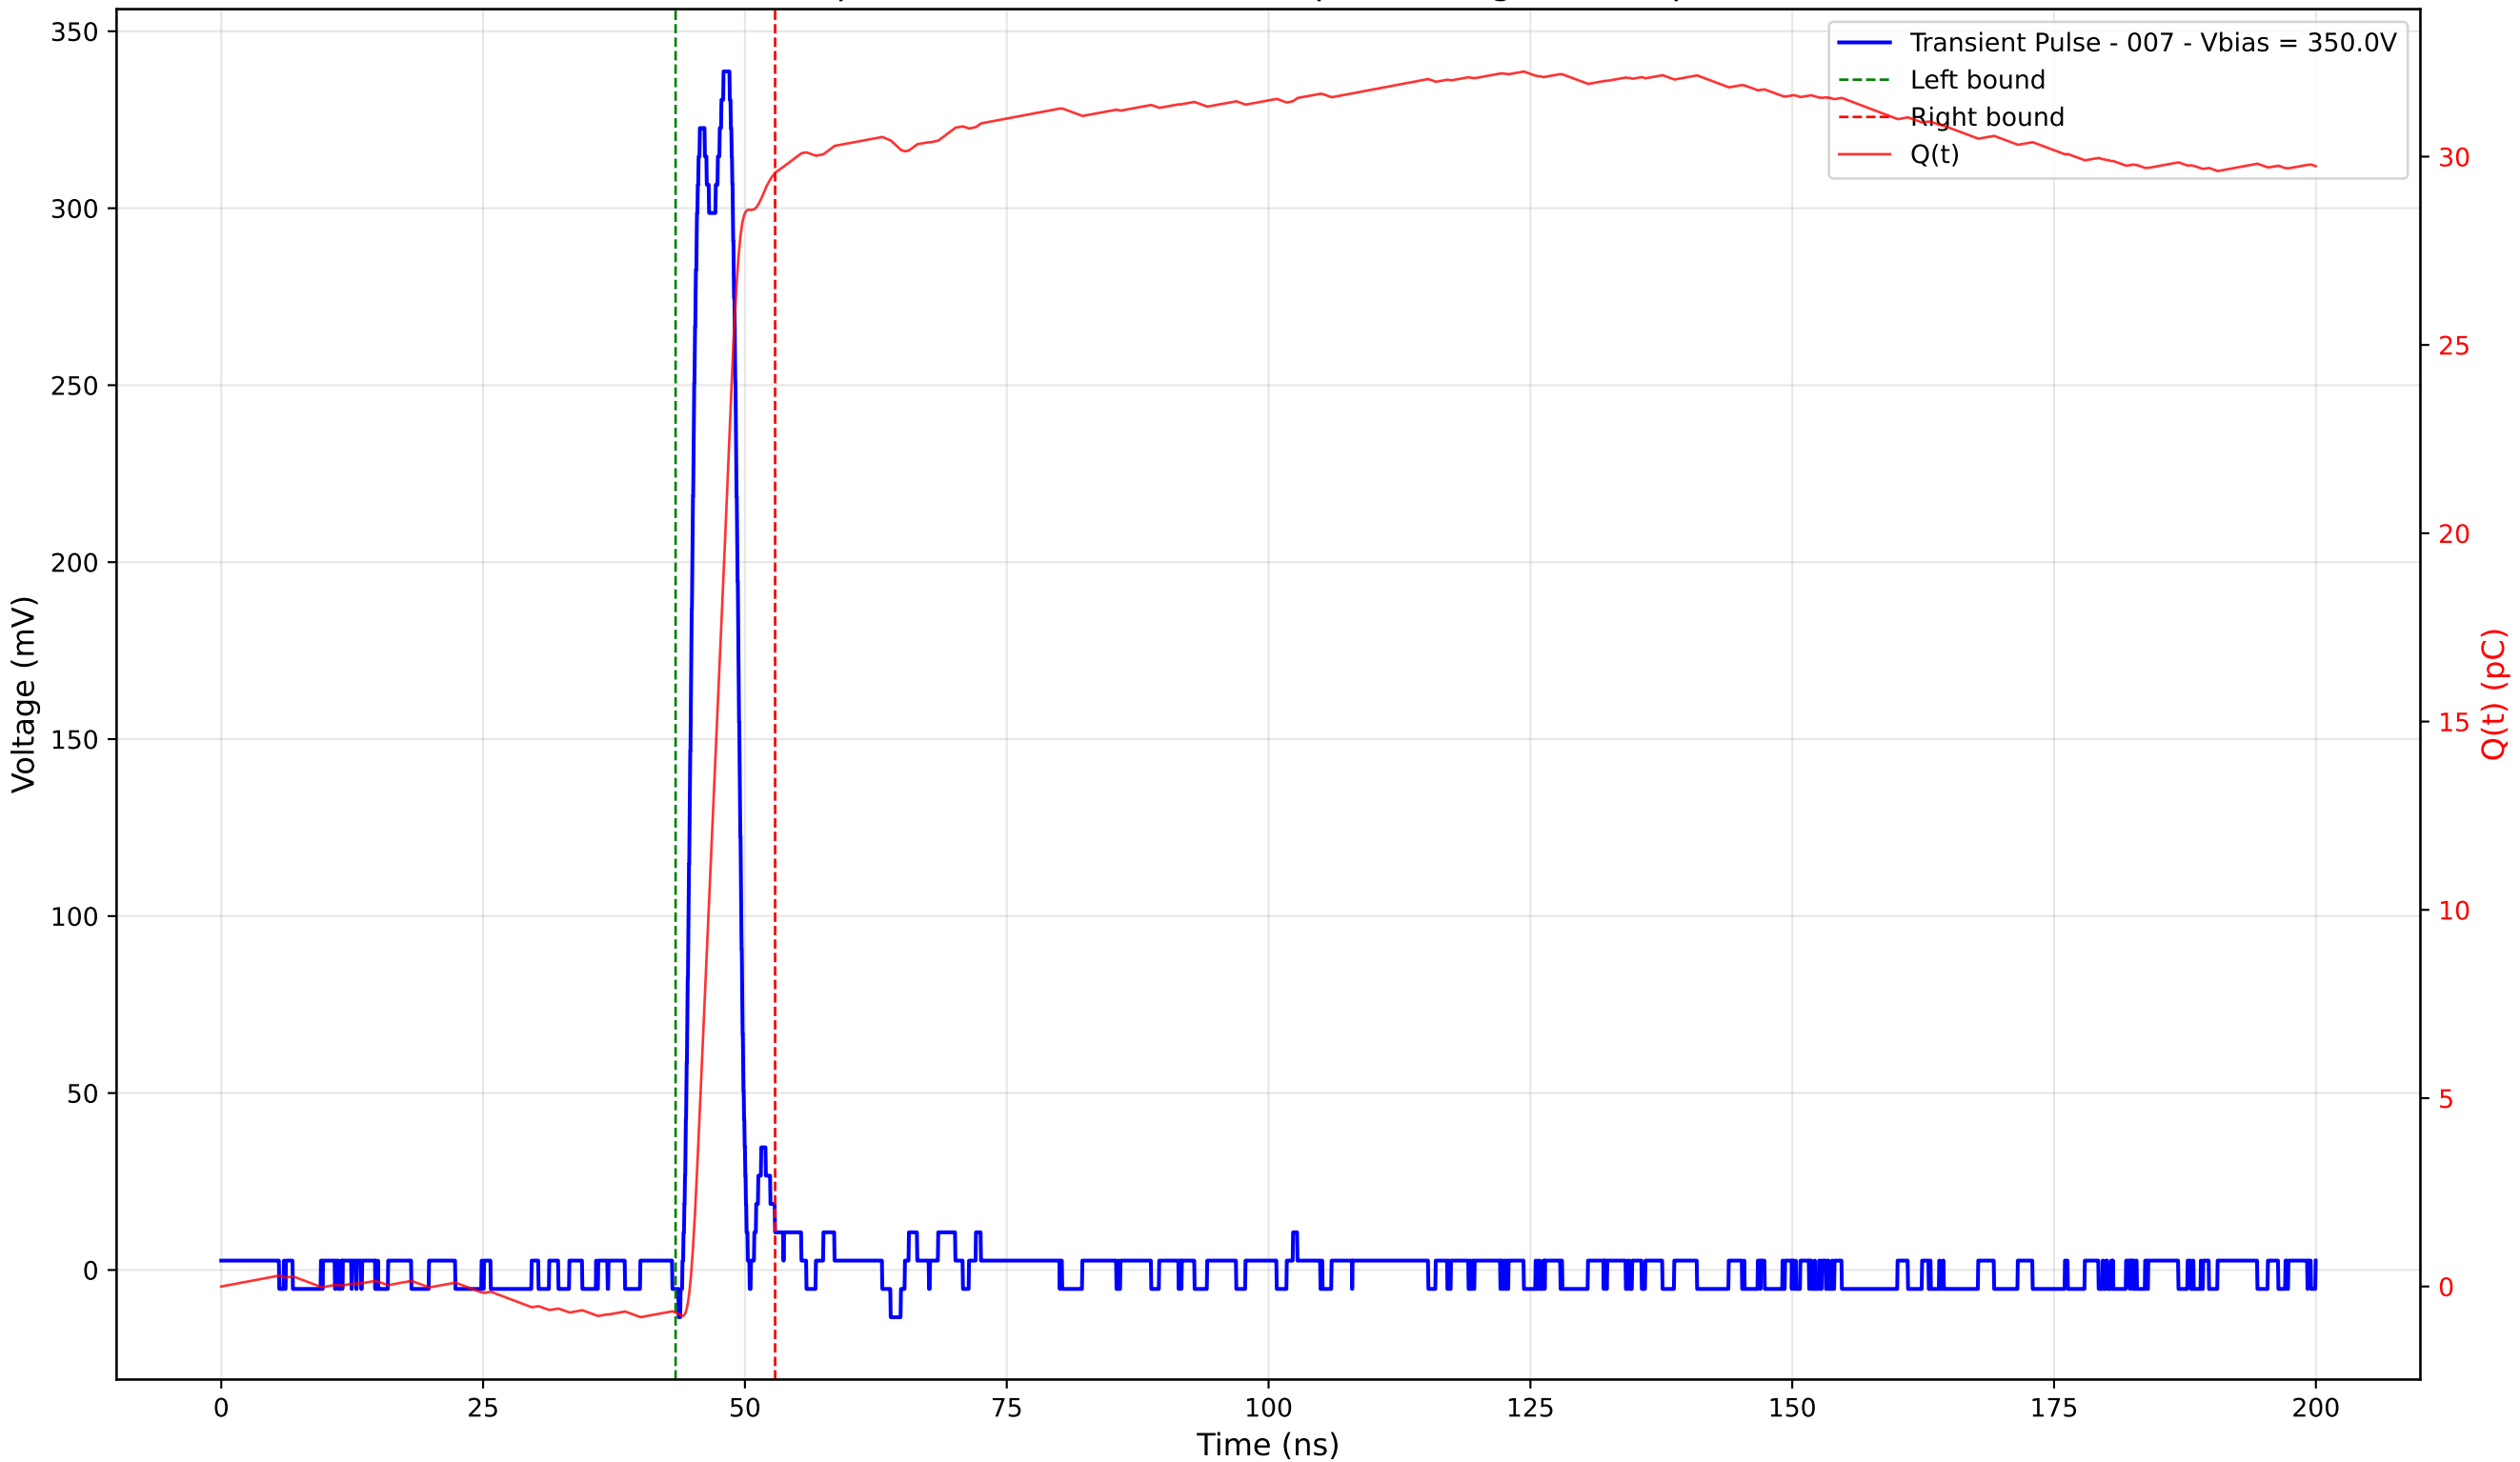


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 26.46 pC - Rise Time: 1.17 ns

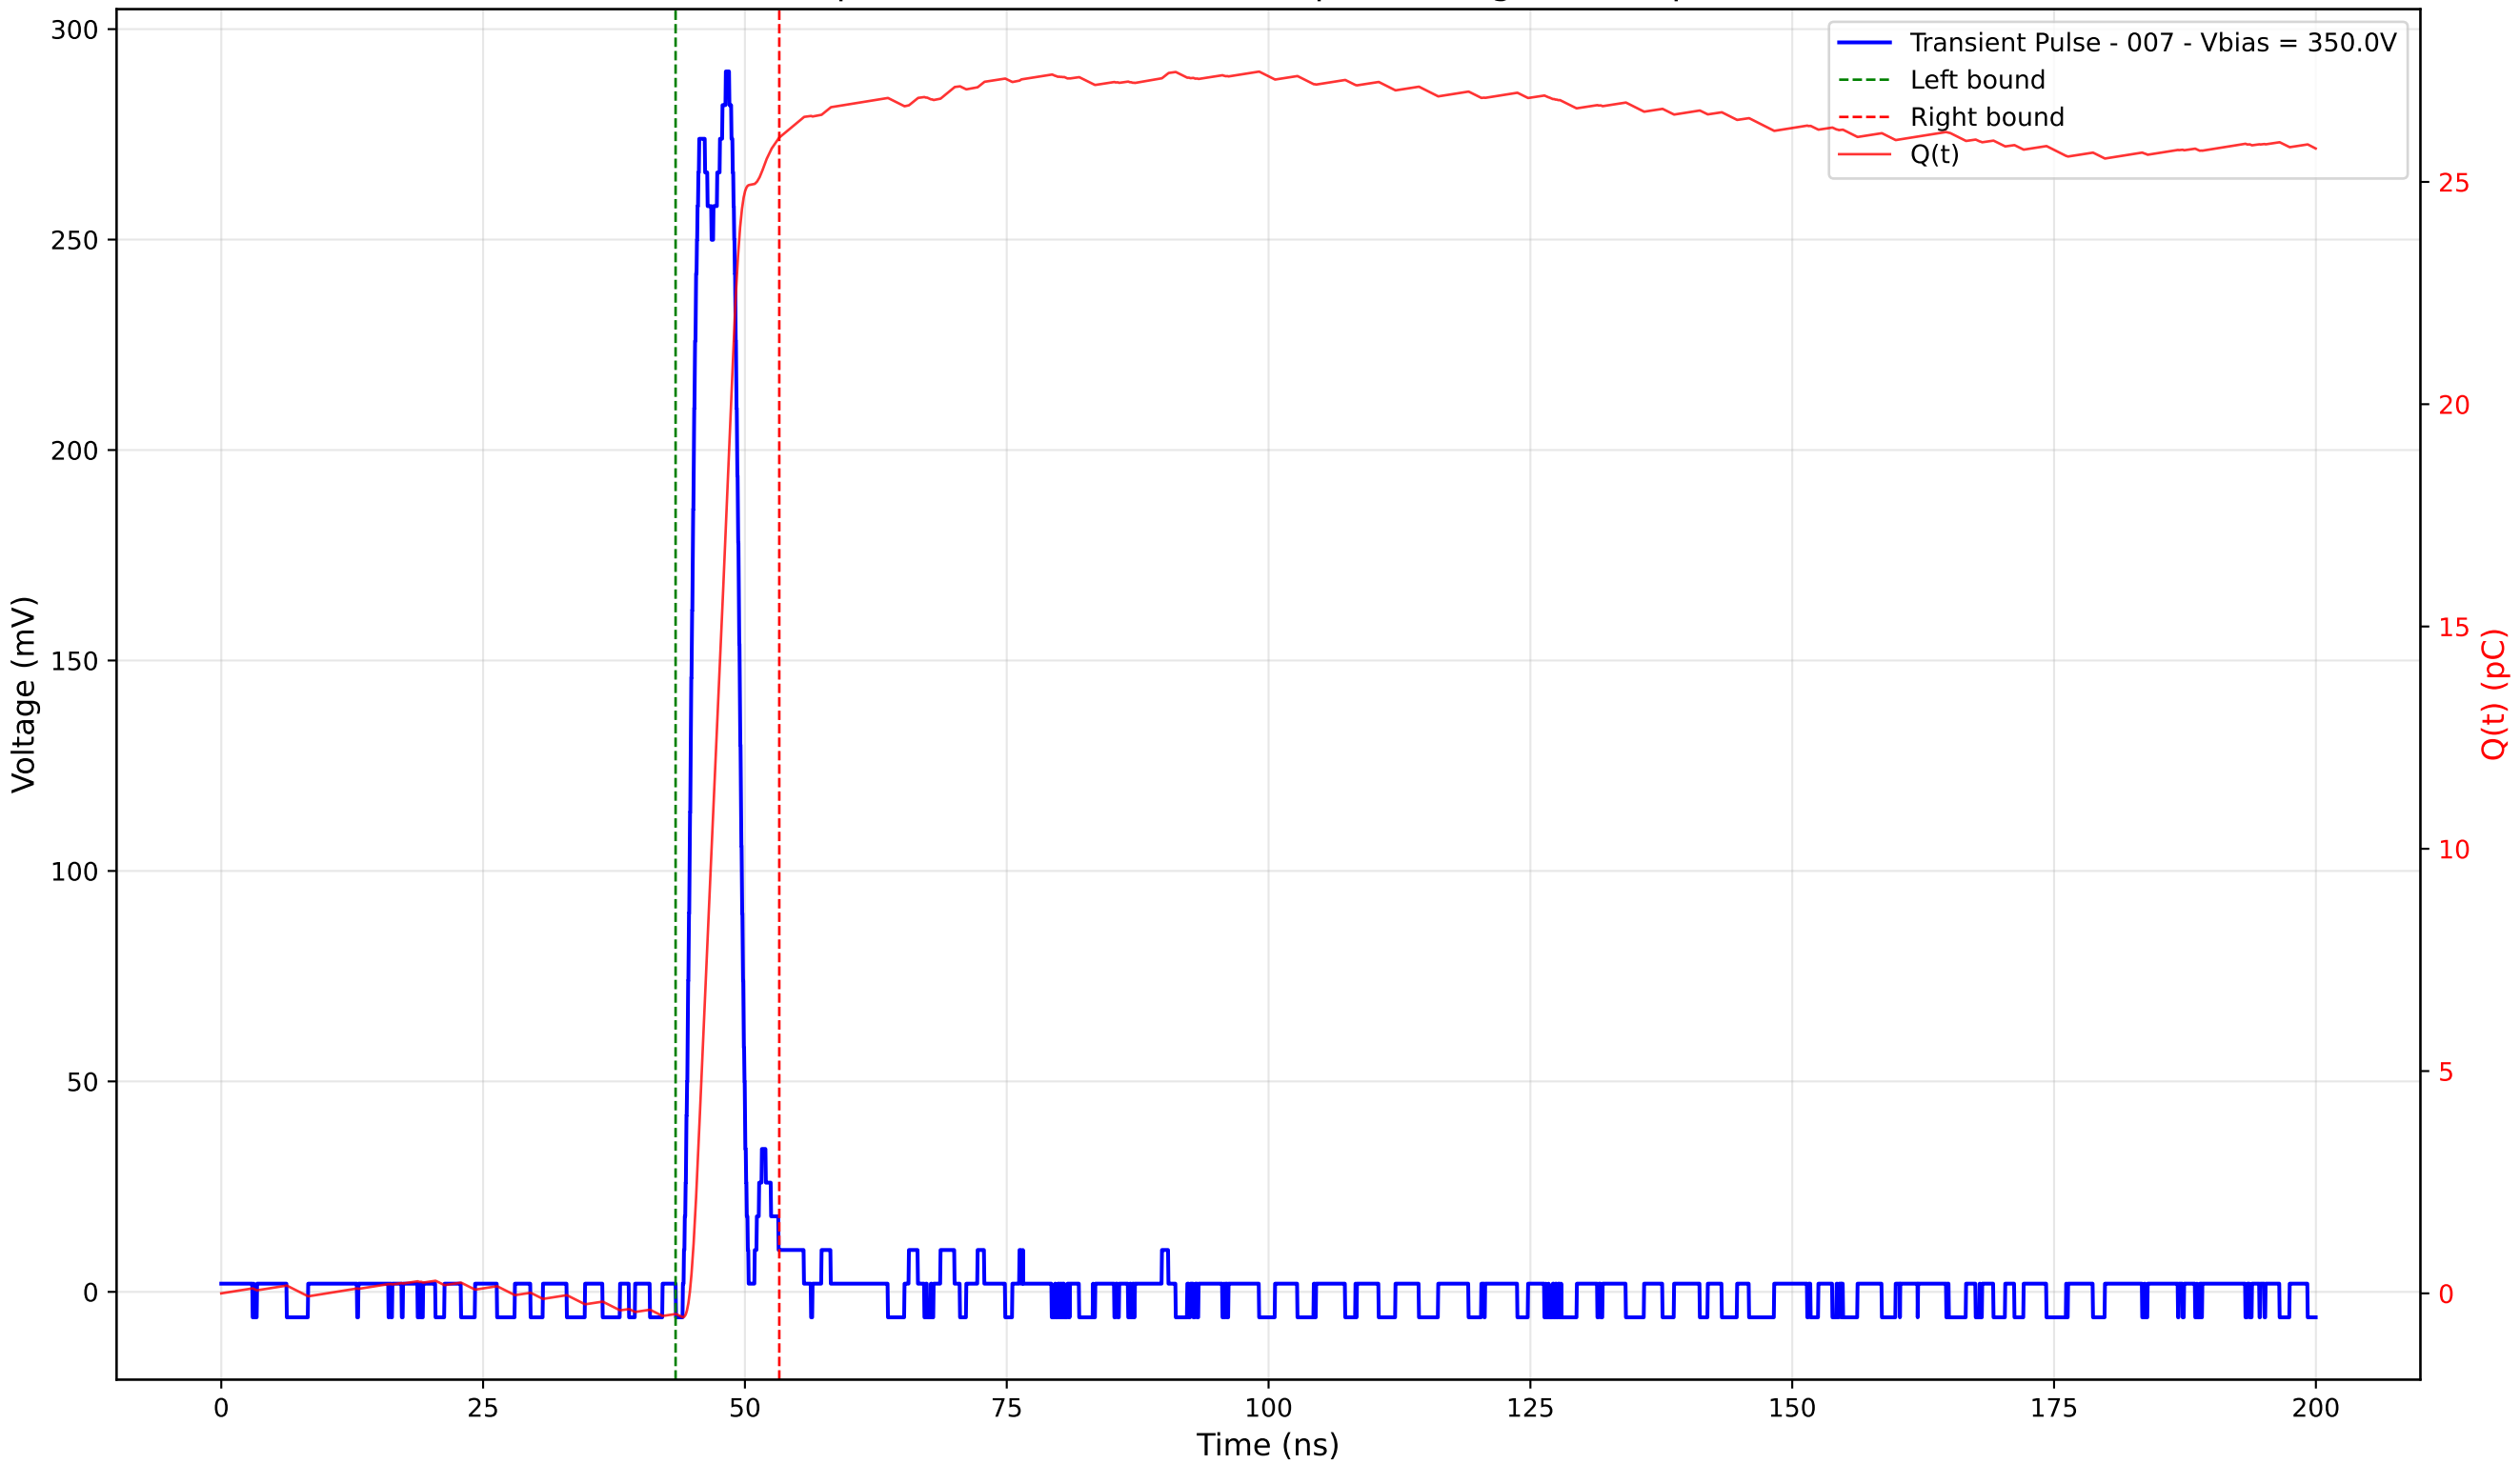


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 21.47 pC - Rise Time: 1.13 ns

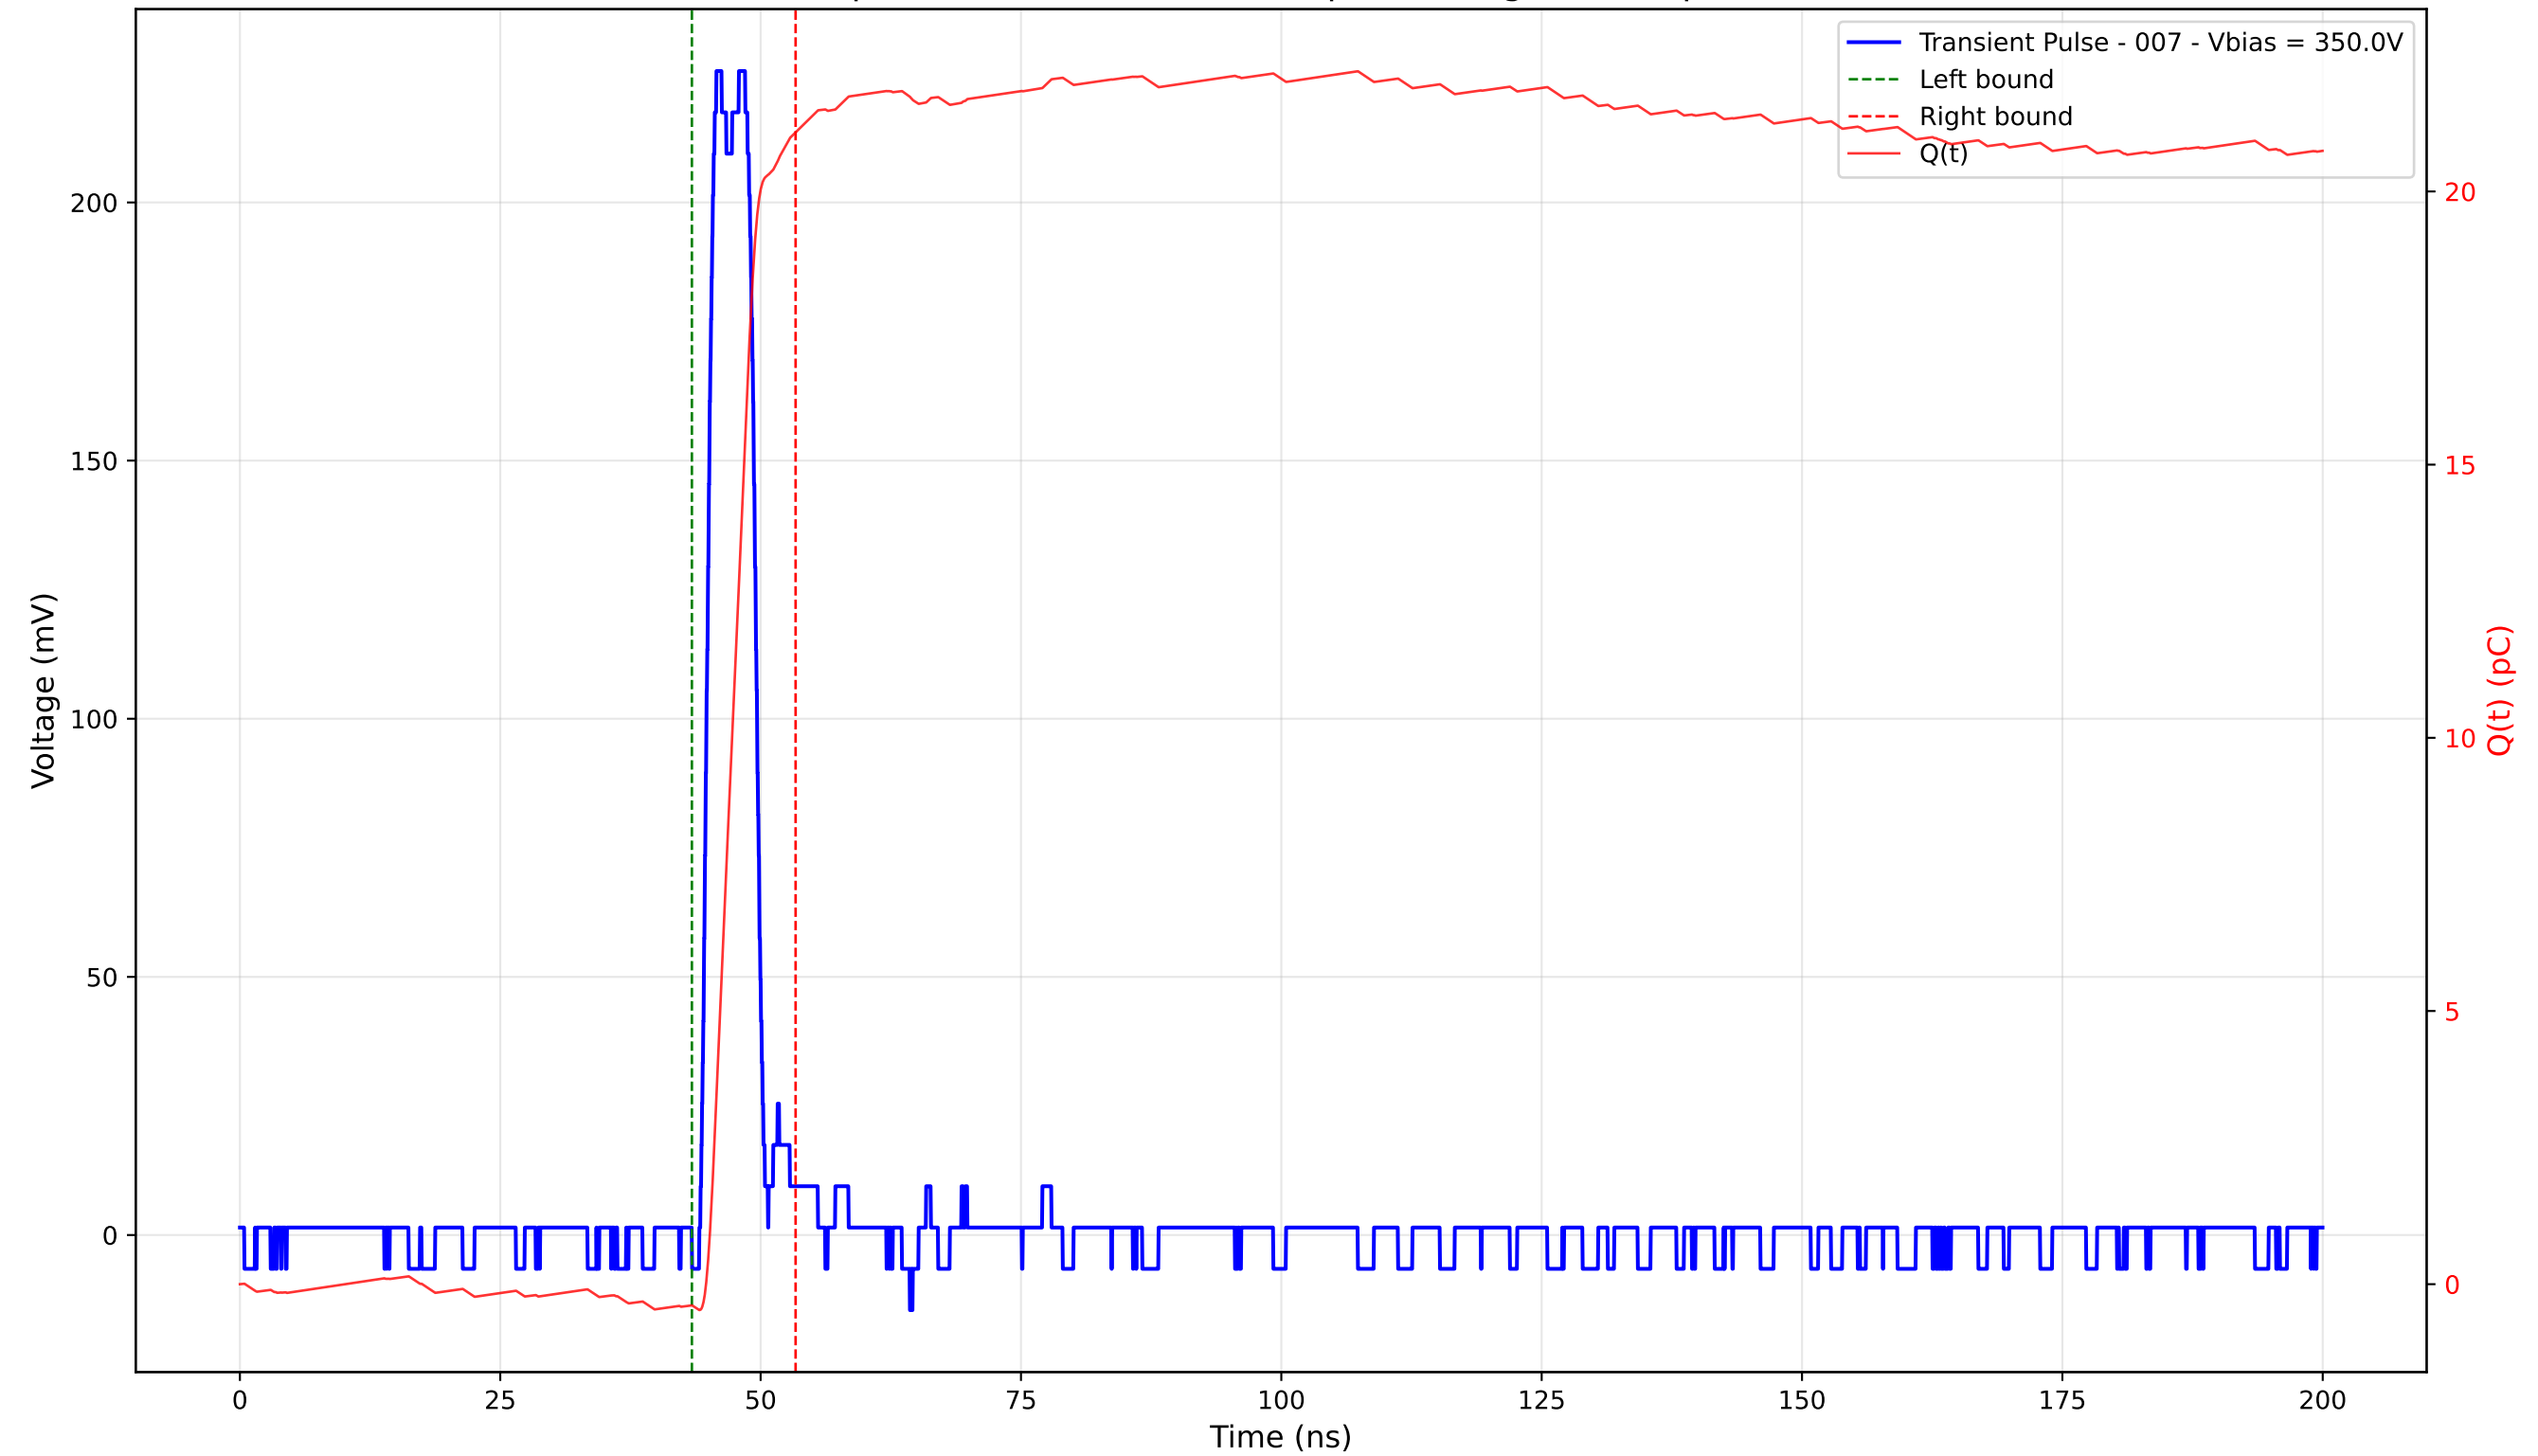


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 16.39 pC - Rise Time: 1.02 ns

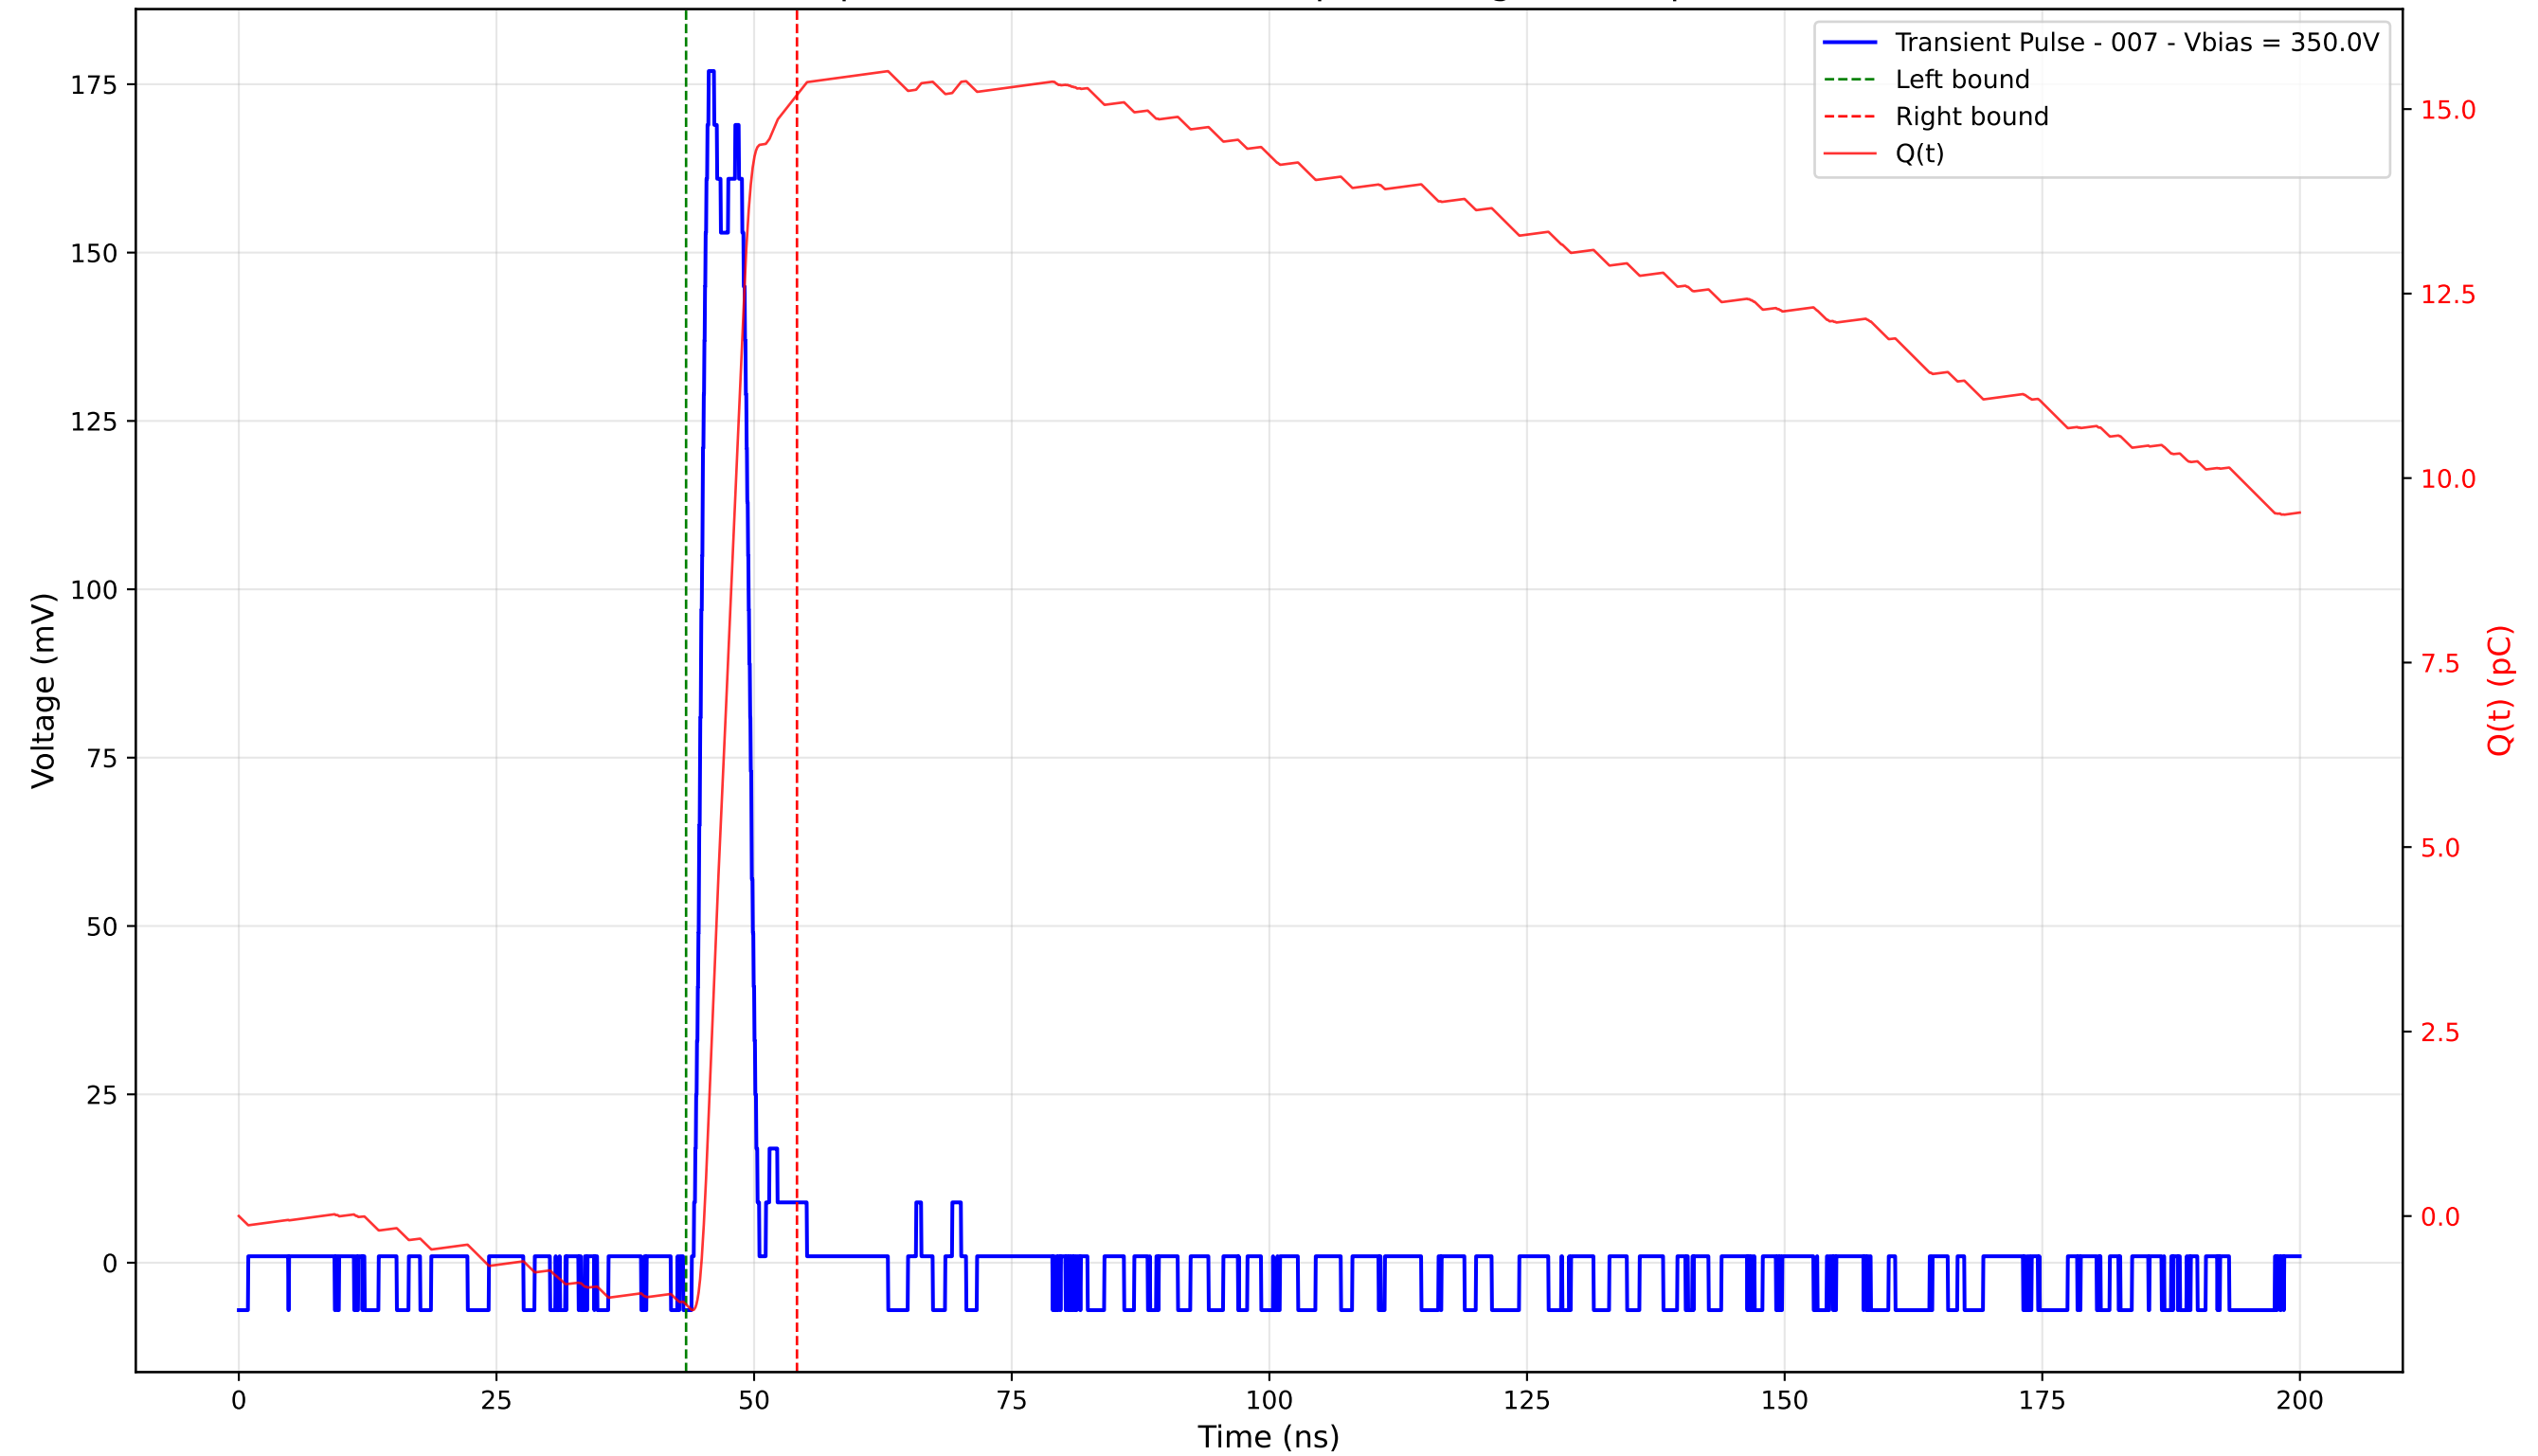


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 11.15 pC - Rise Time: 1.11 ns

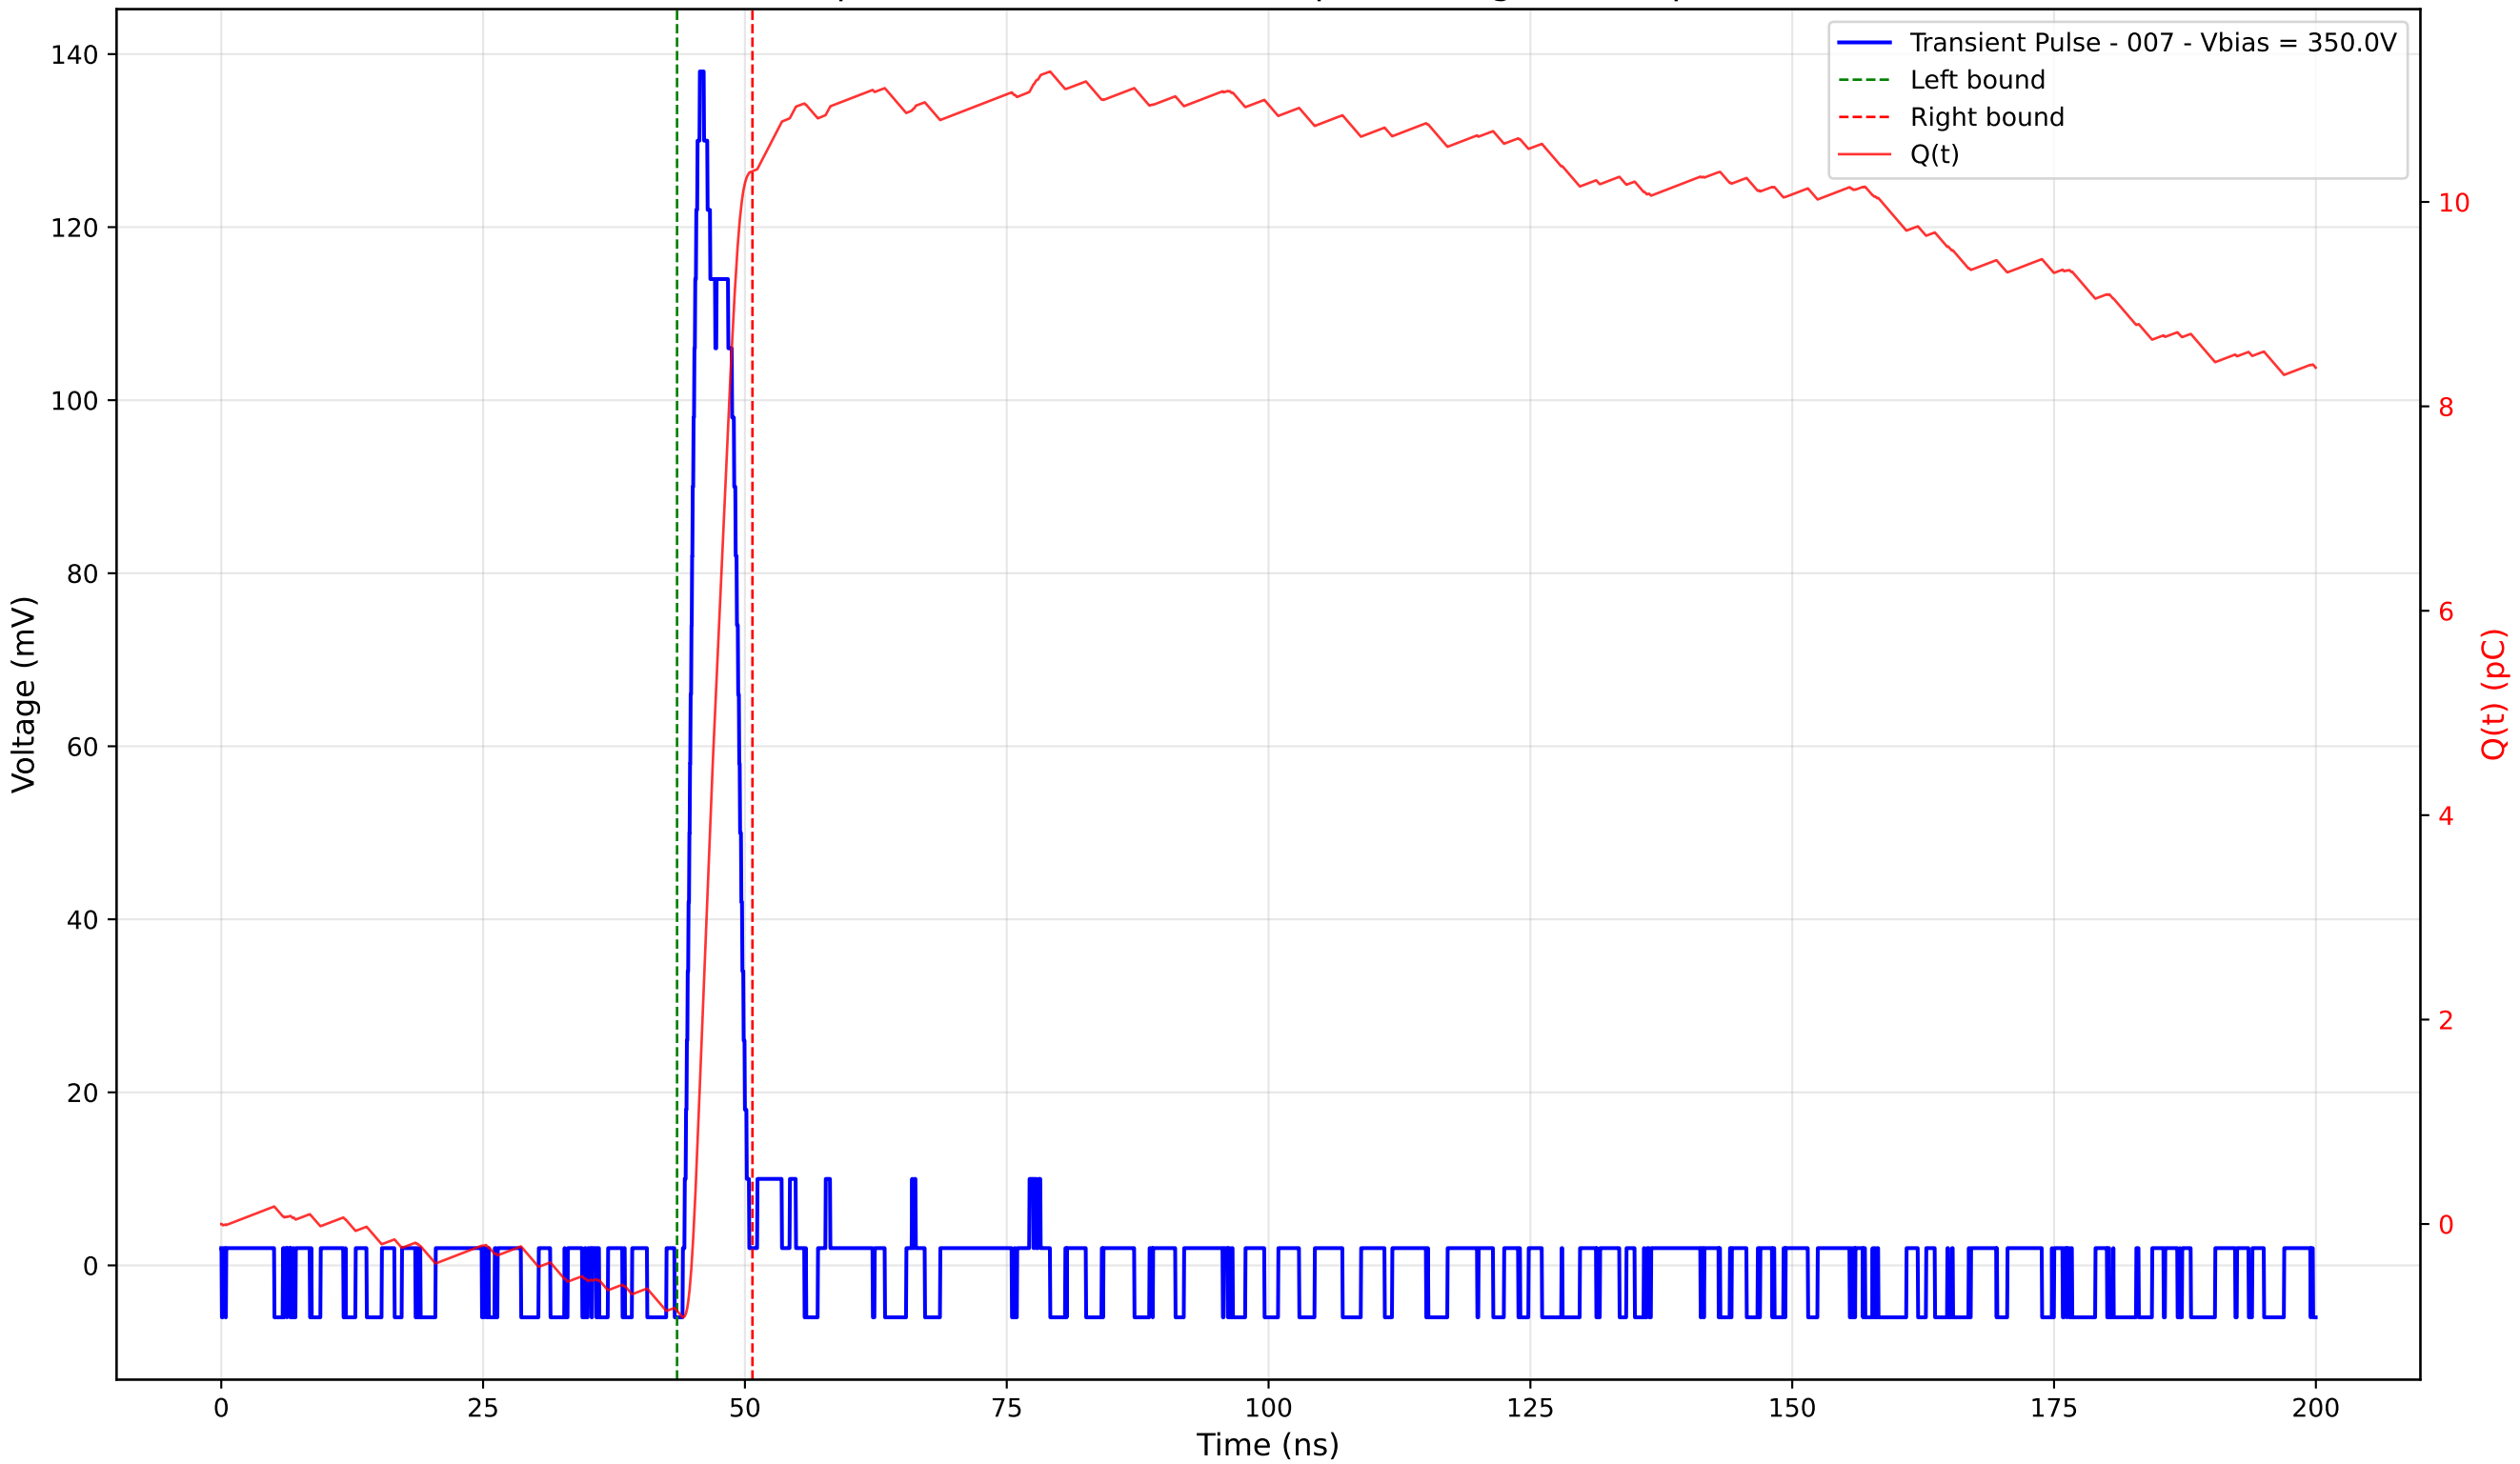


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 6.58 pC - Rise Time: 1.00 ns

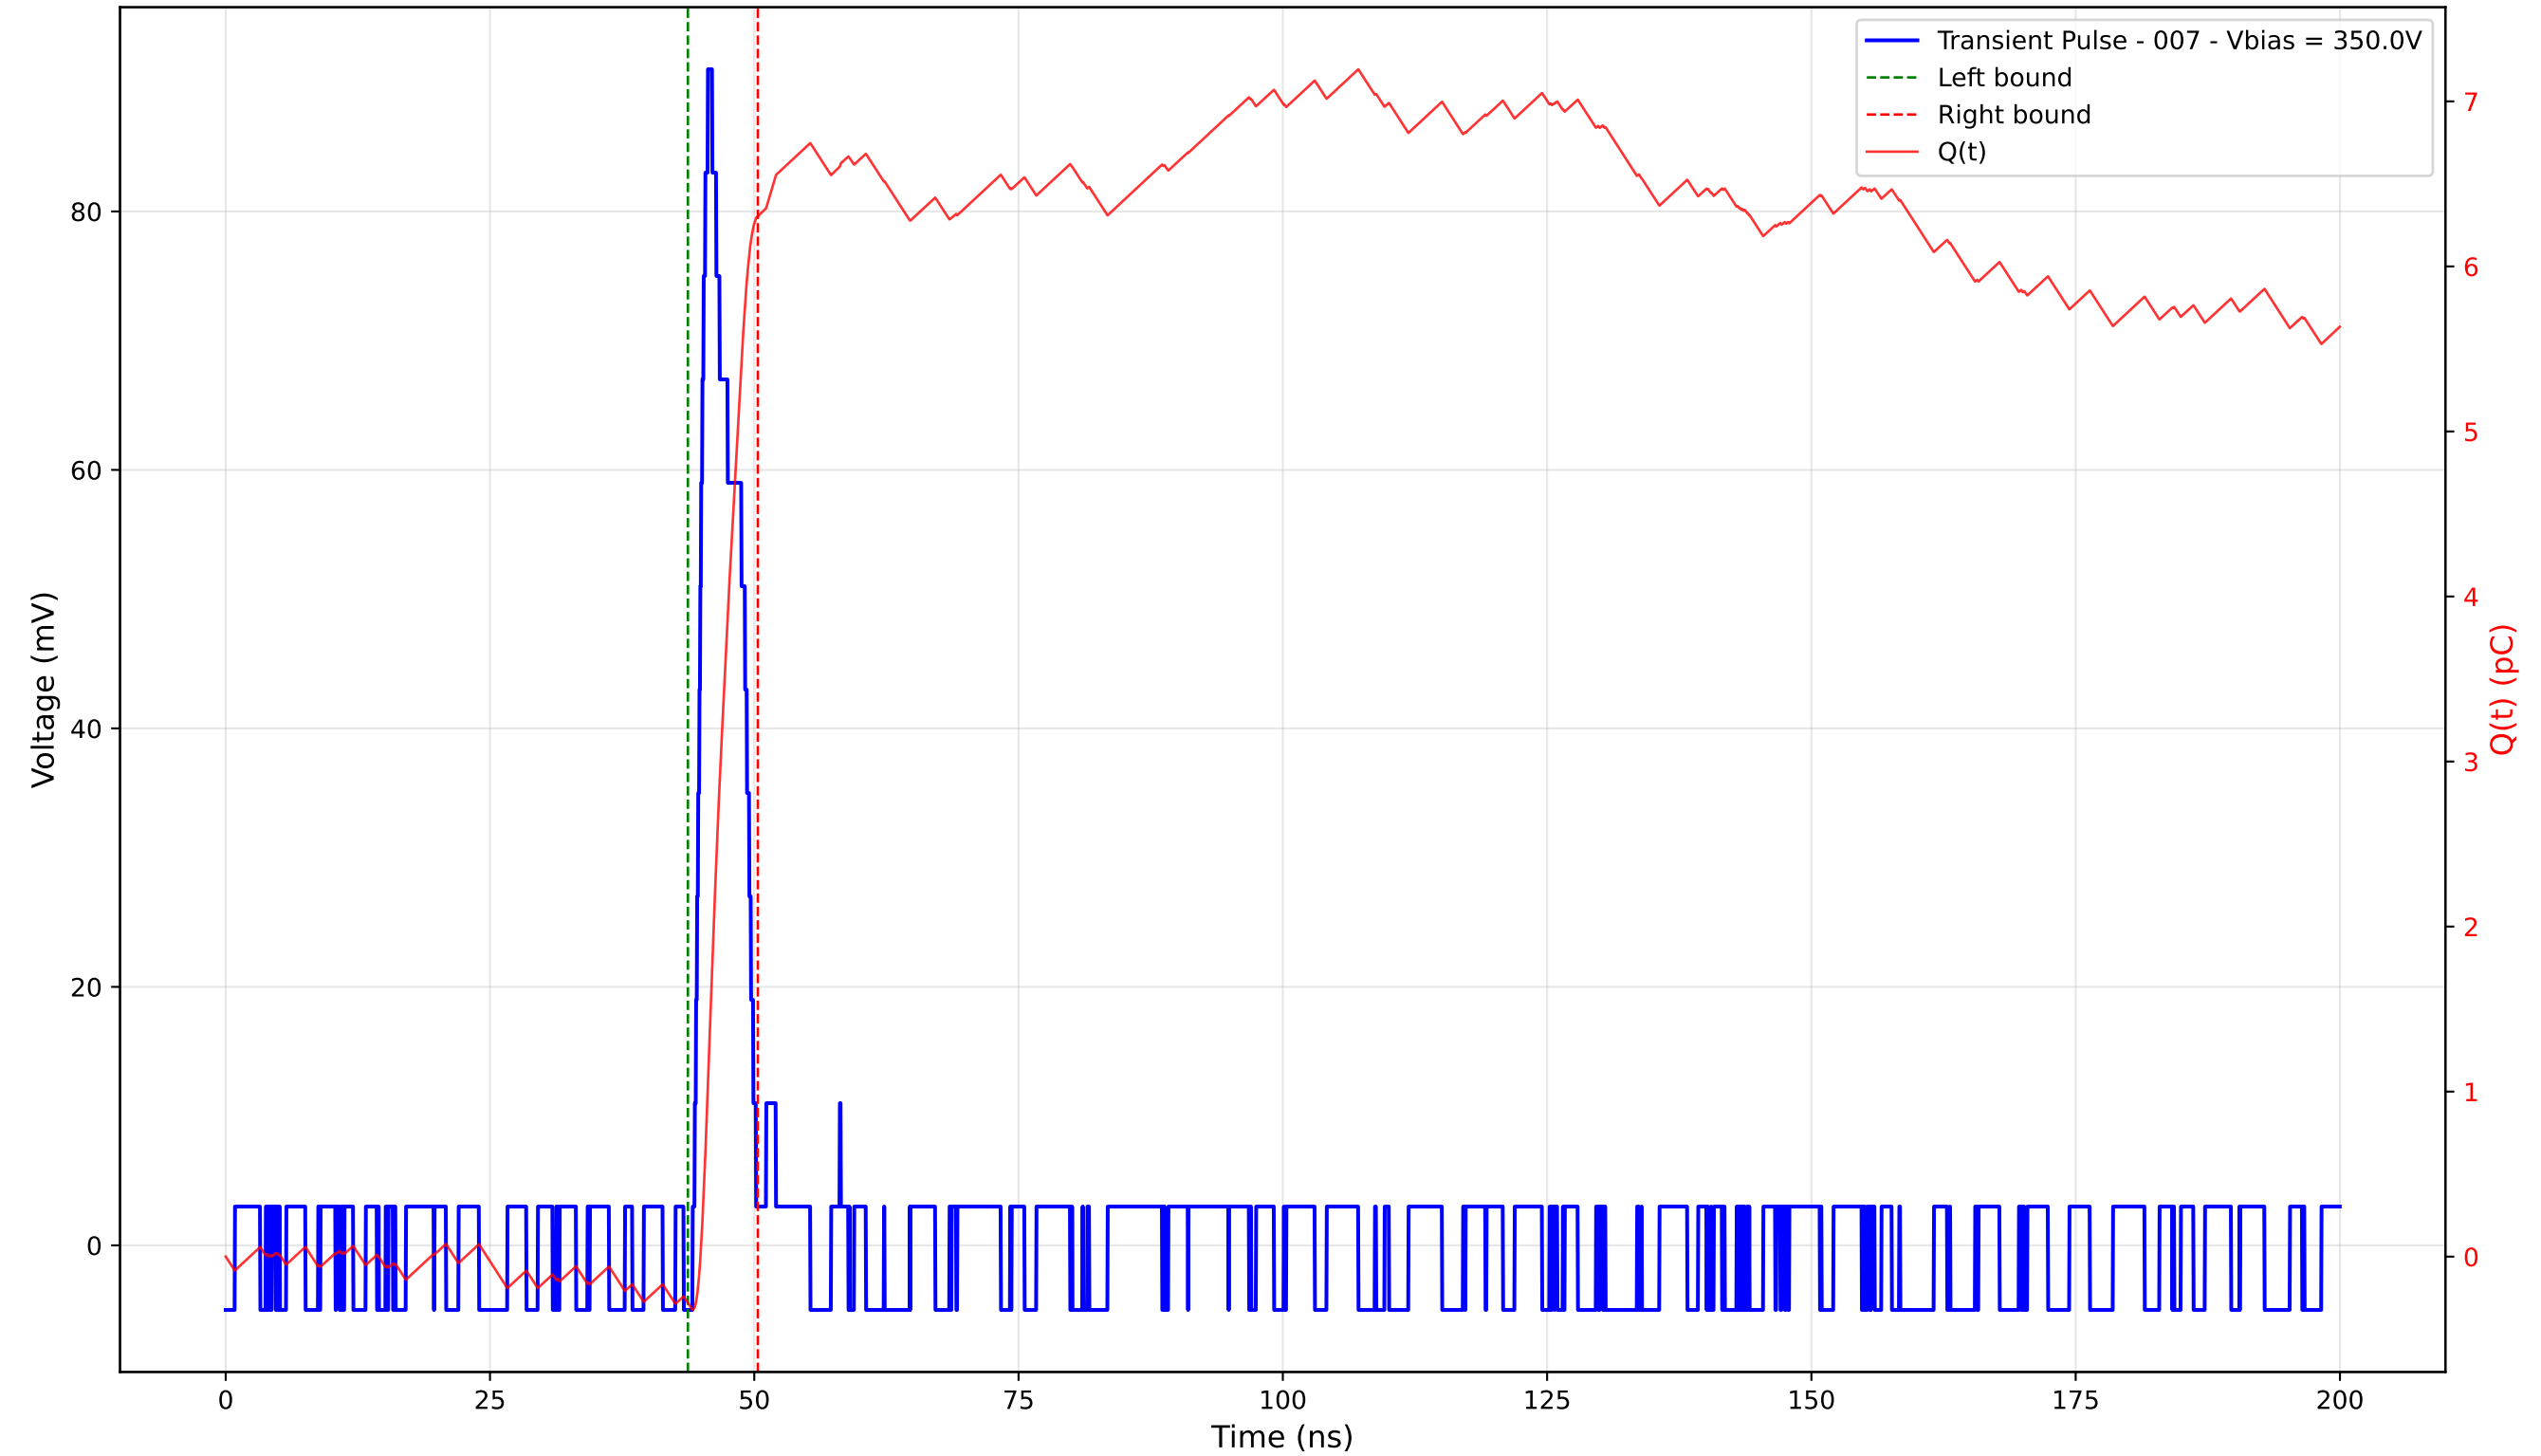


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 3.51 pC - Rise Time: 1.01 ns

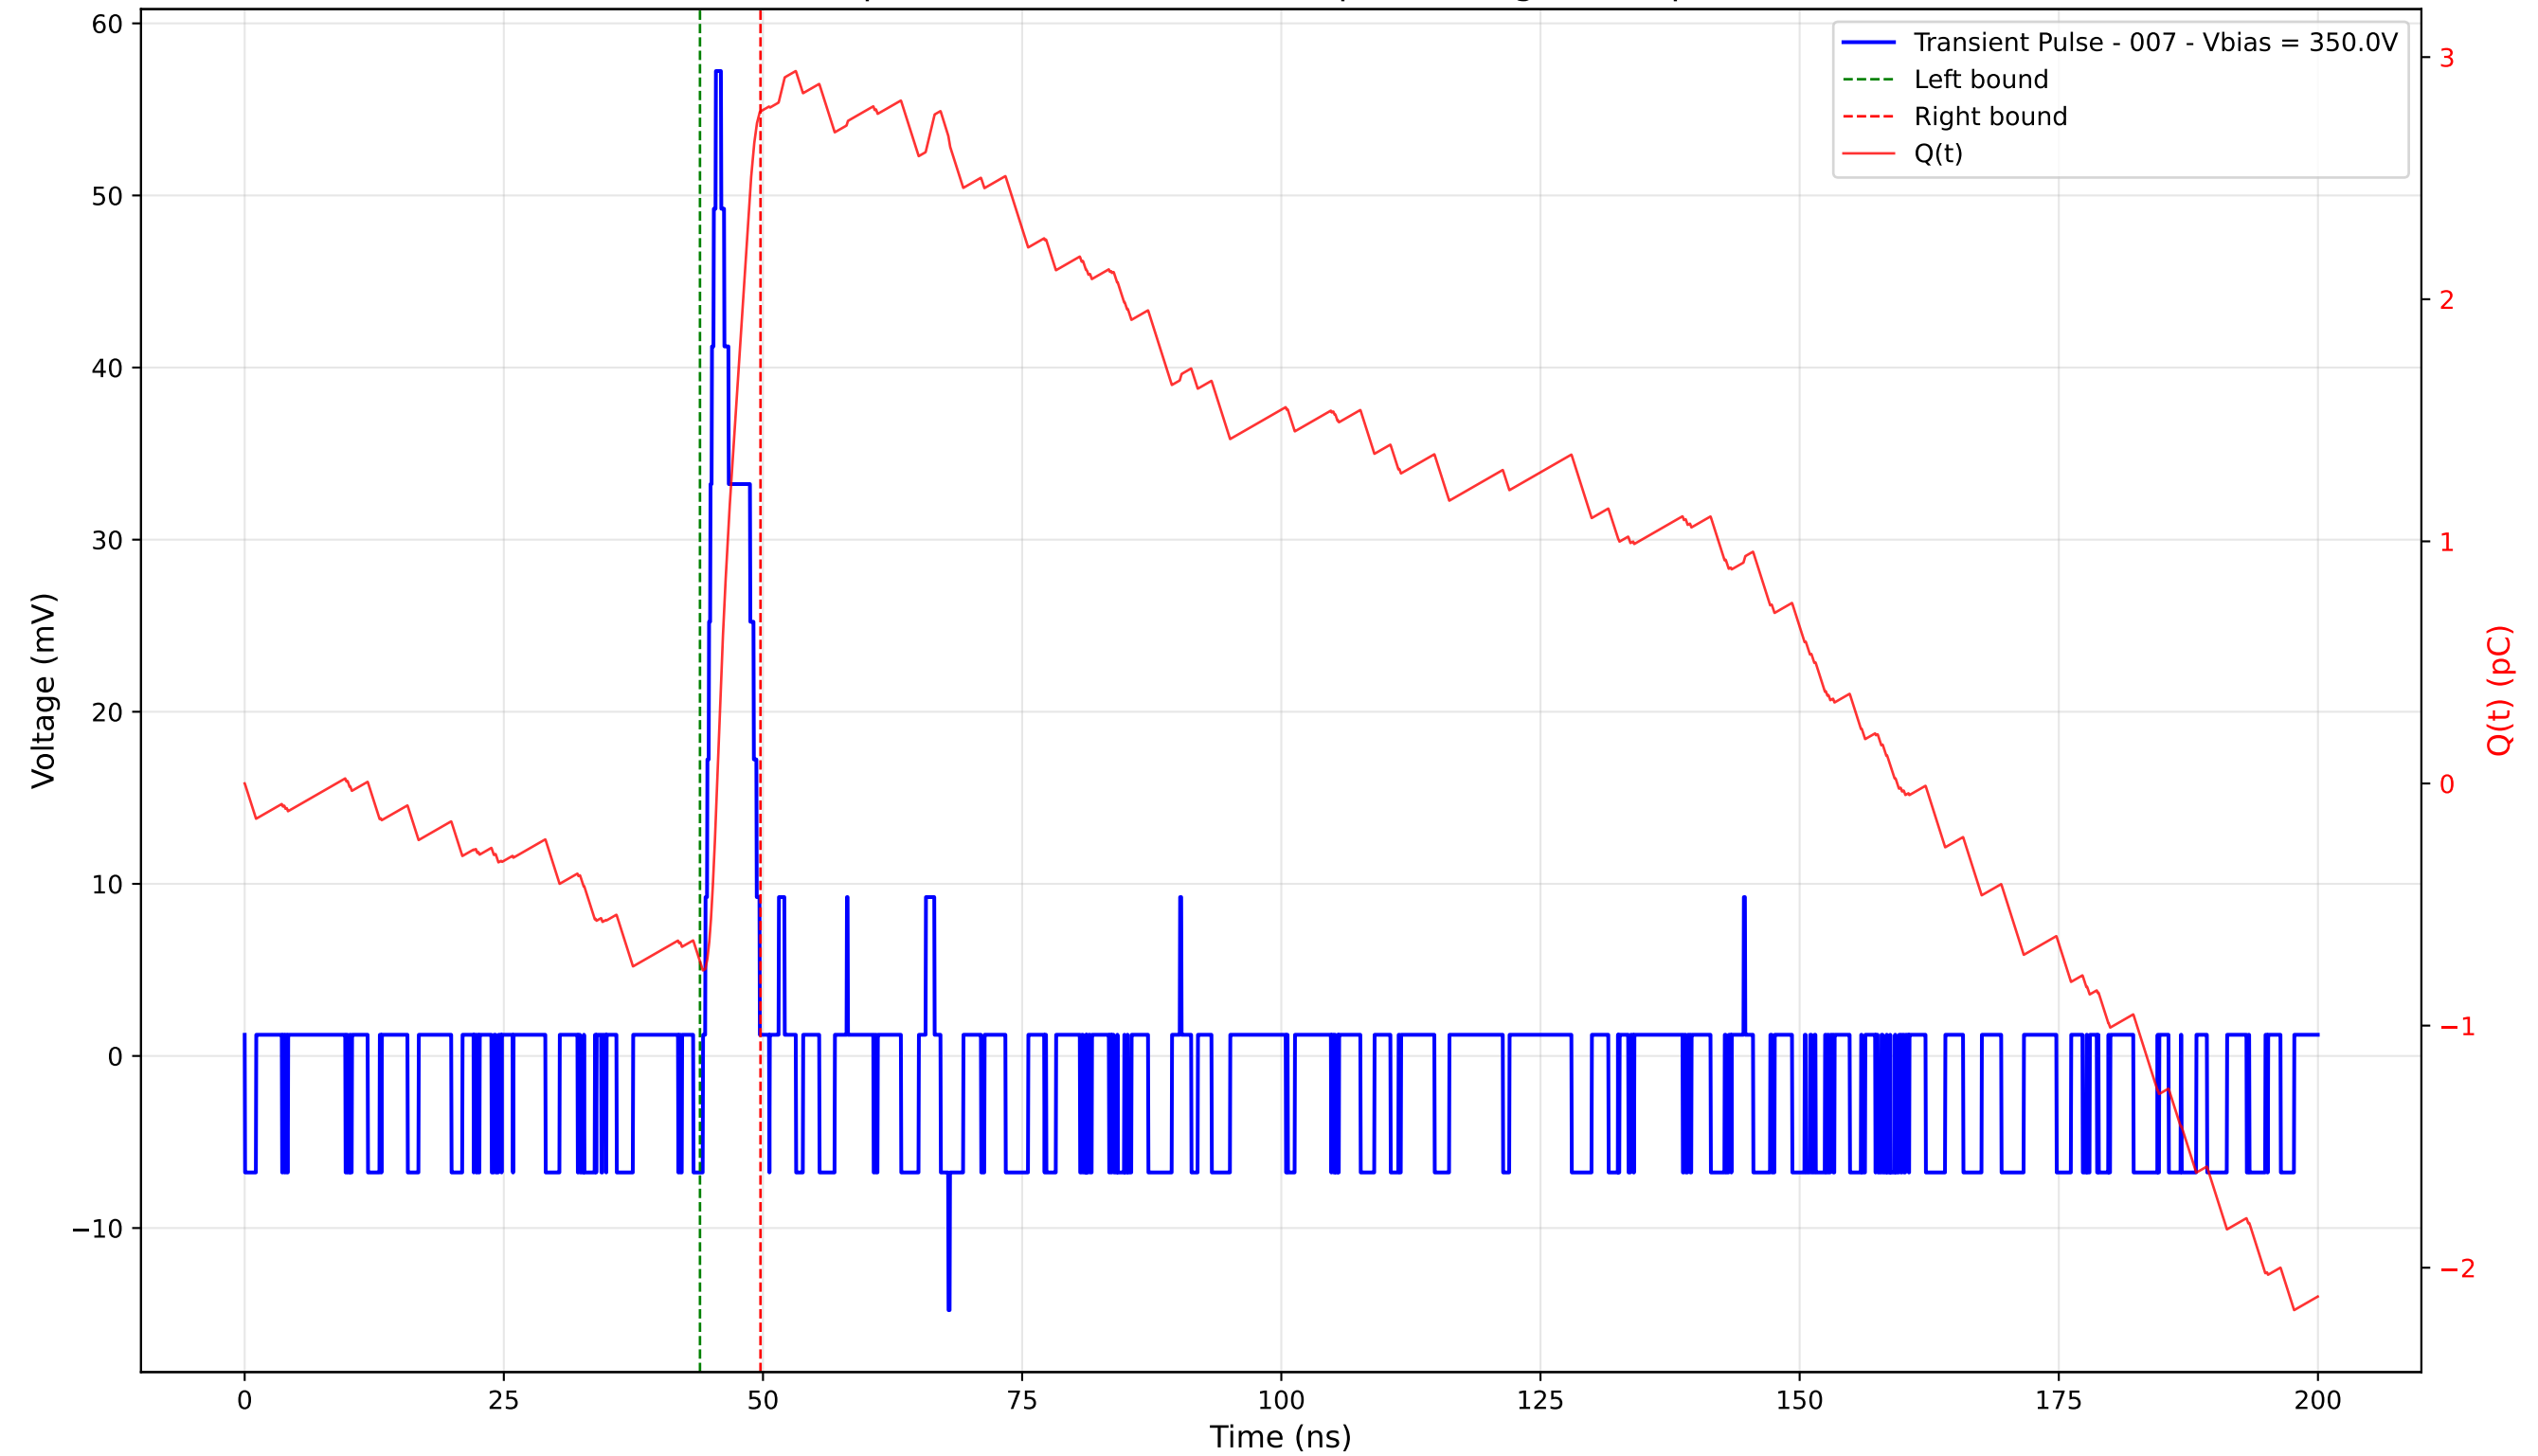

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.02 pC - Rise Time: 0.68 ns

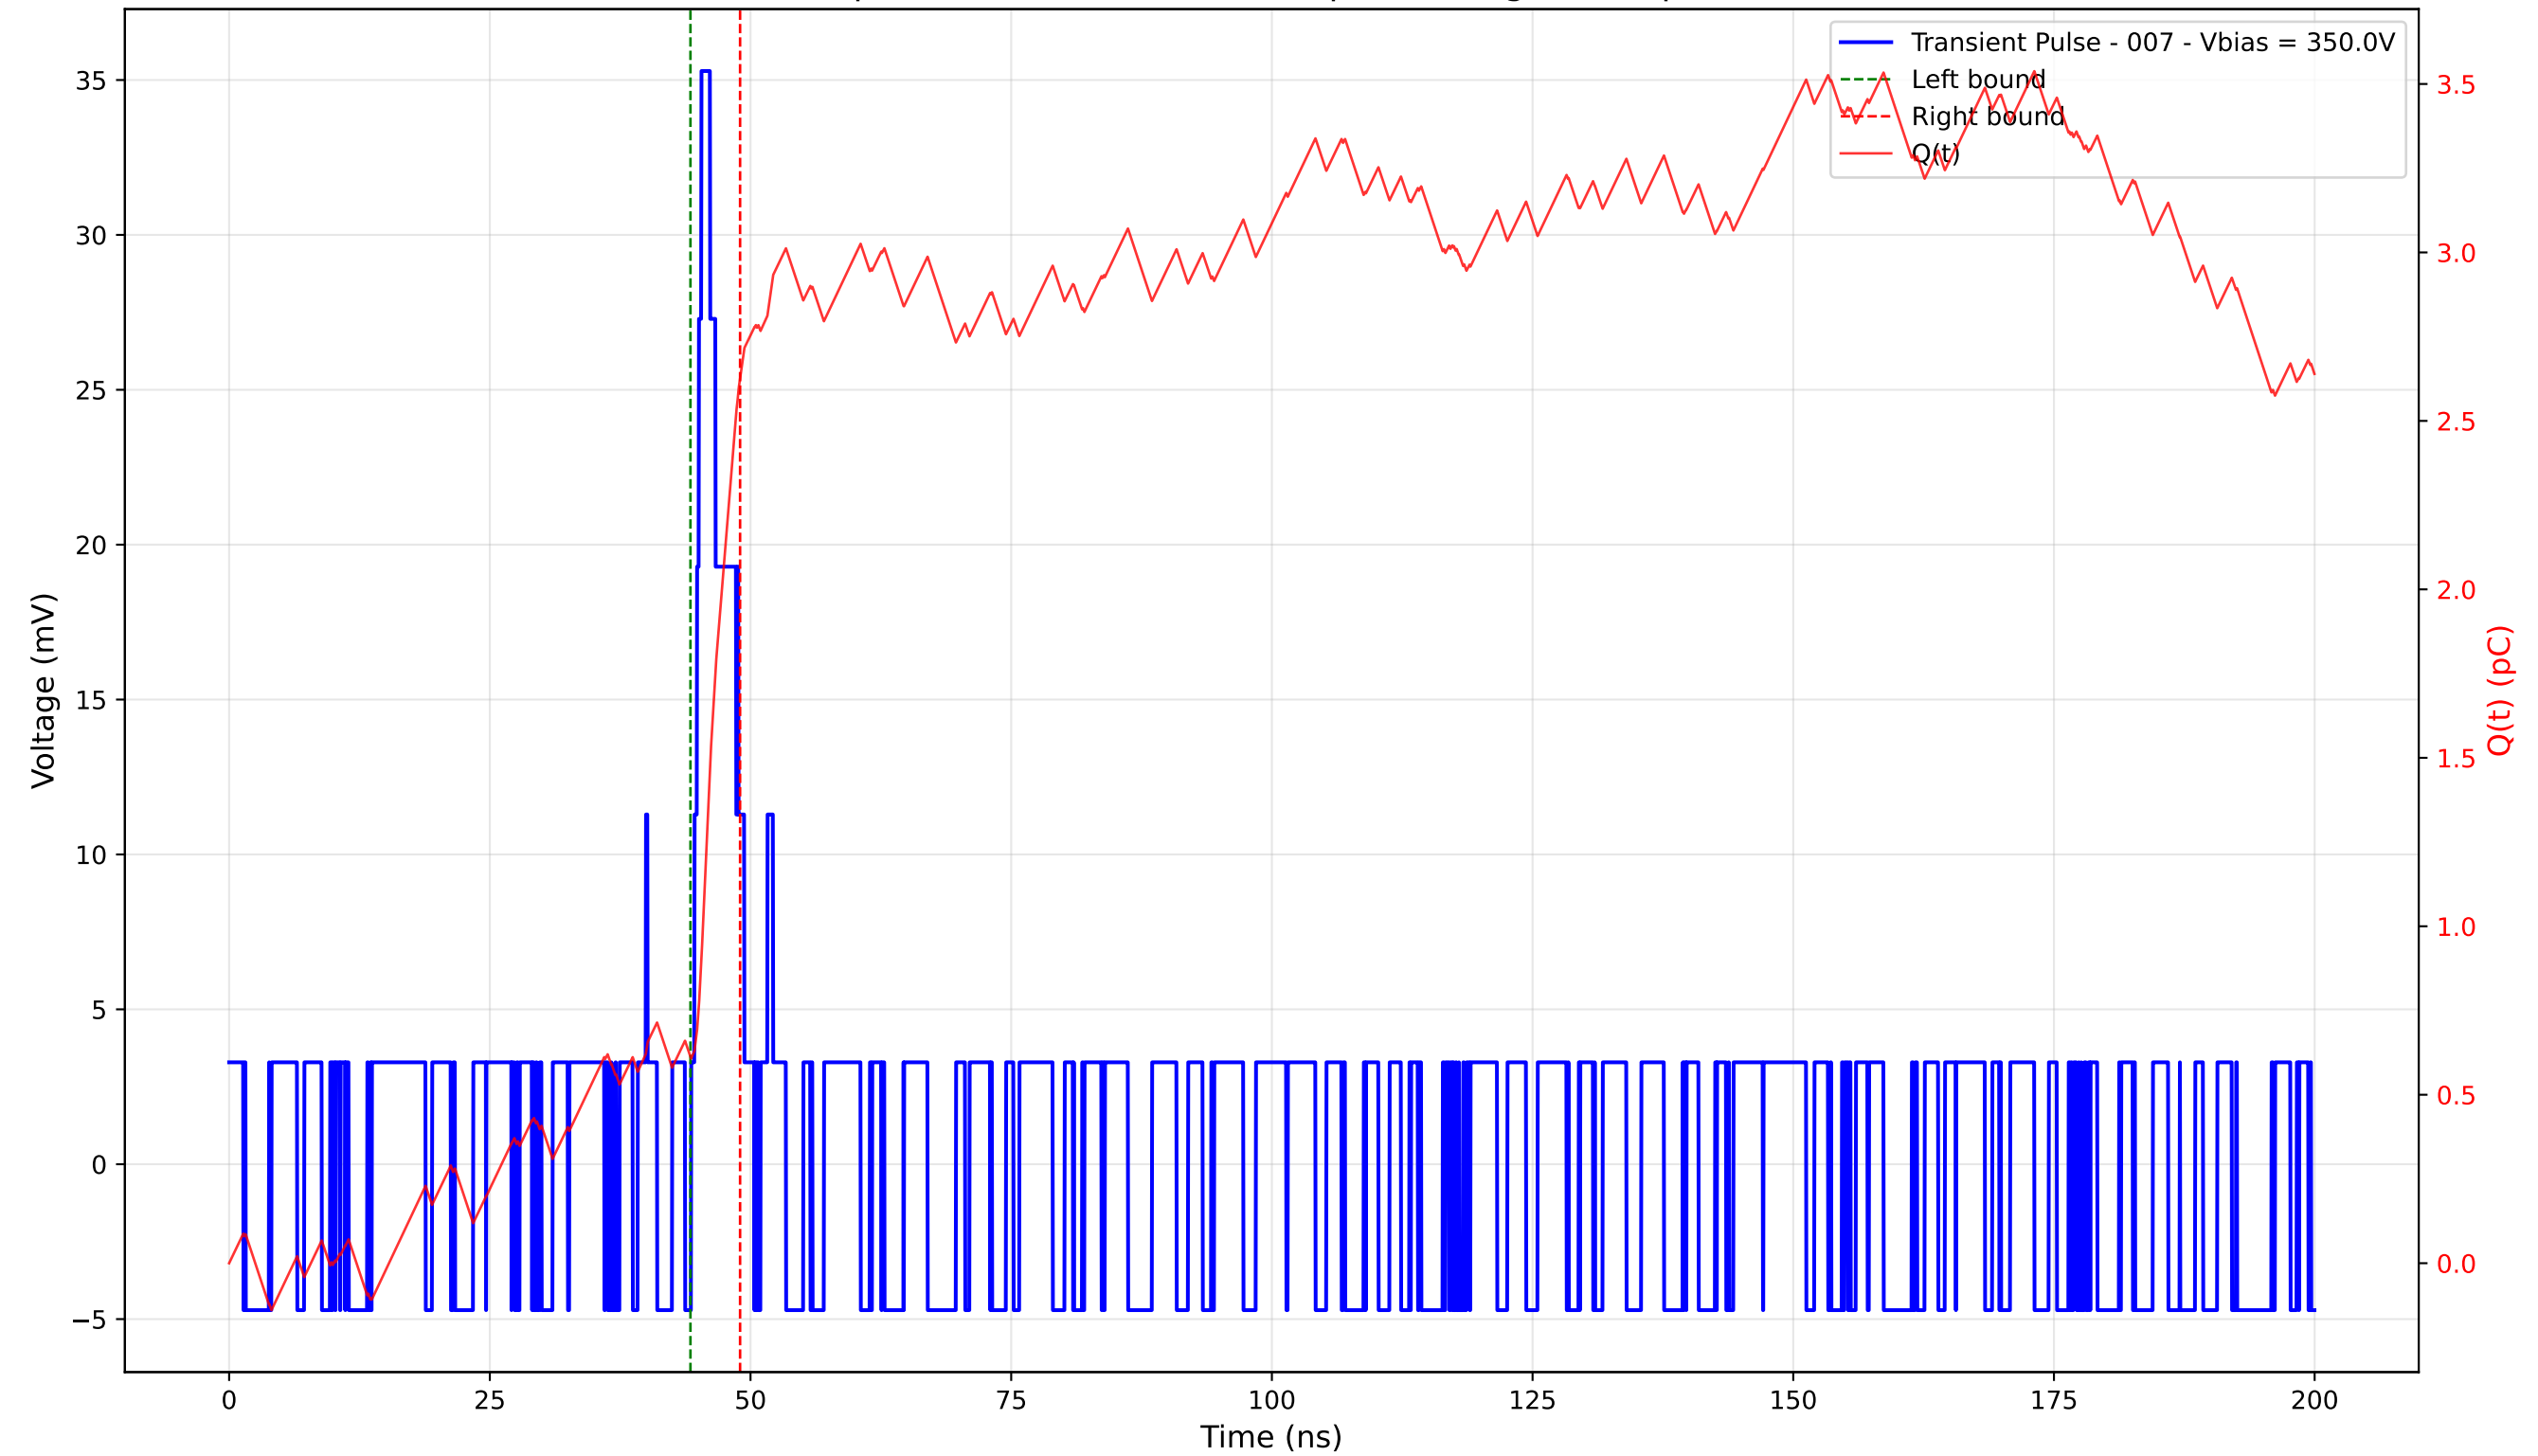

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 0.79 pC - Rise Time: 0.00 ns (N/A)

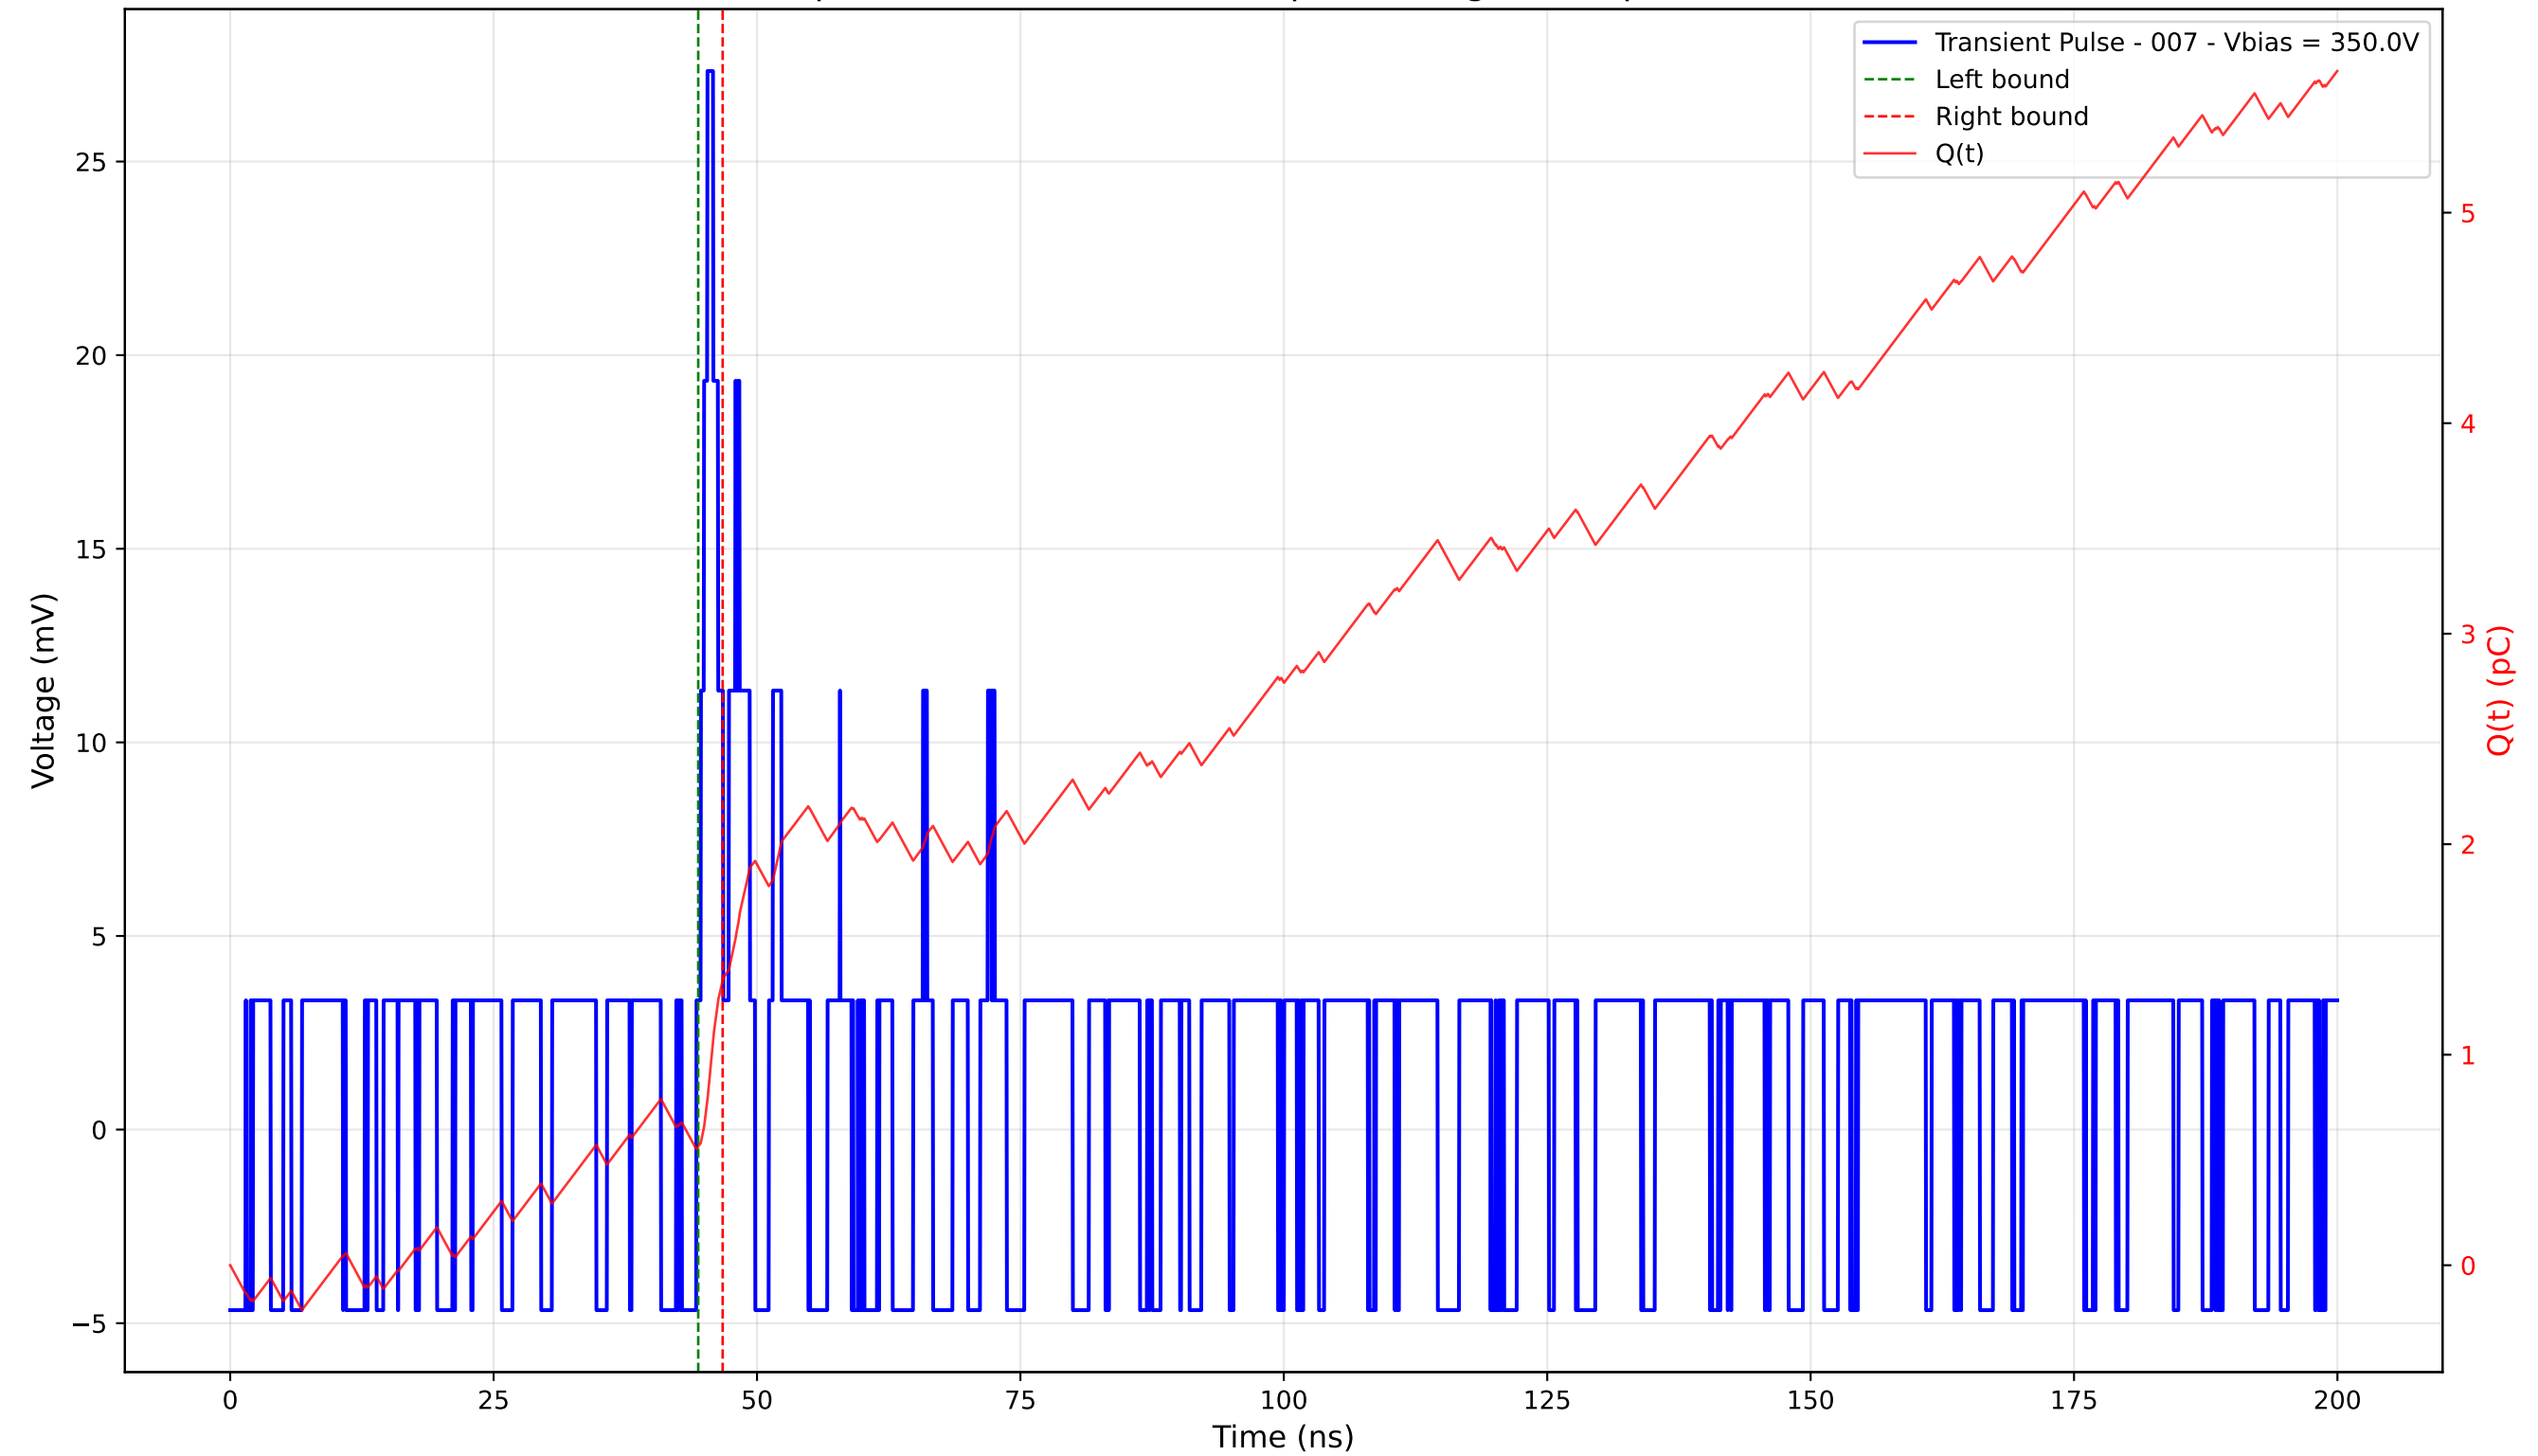

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.85 pC - Rise Time: 0.48 ns

