


TCT Run 008 Summary

Parameter	Value
Run	Run008
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	330.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\330V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

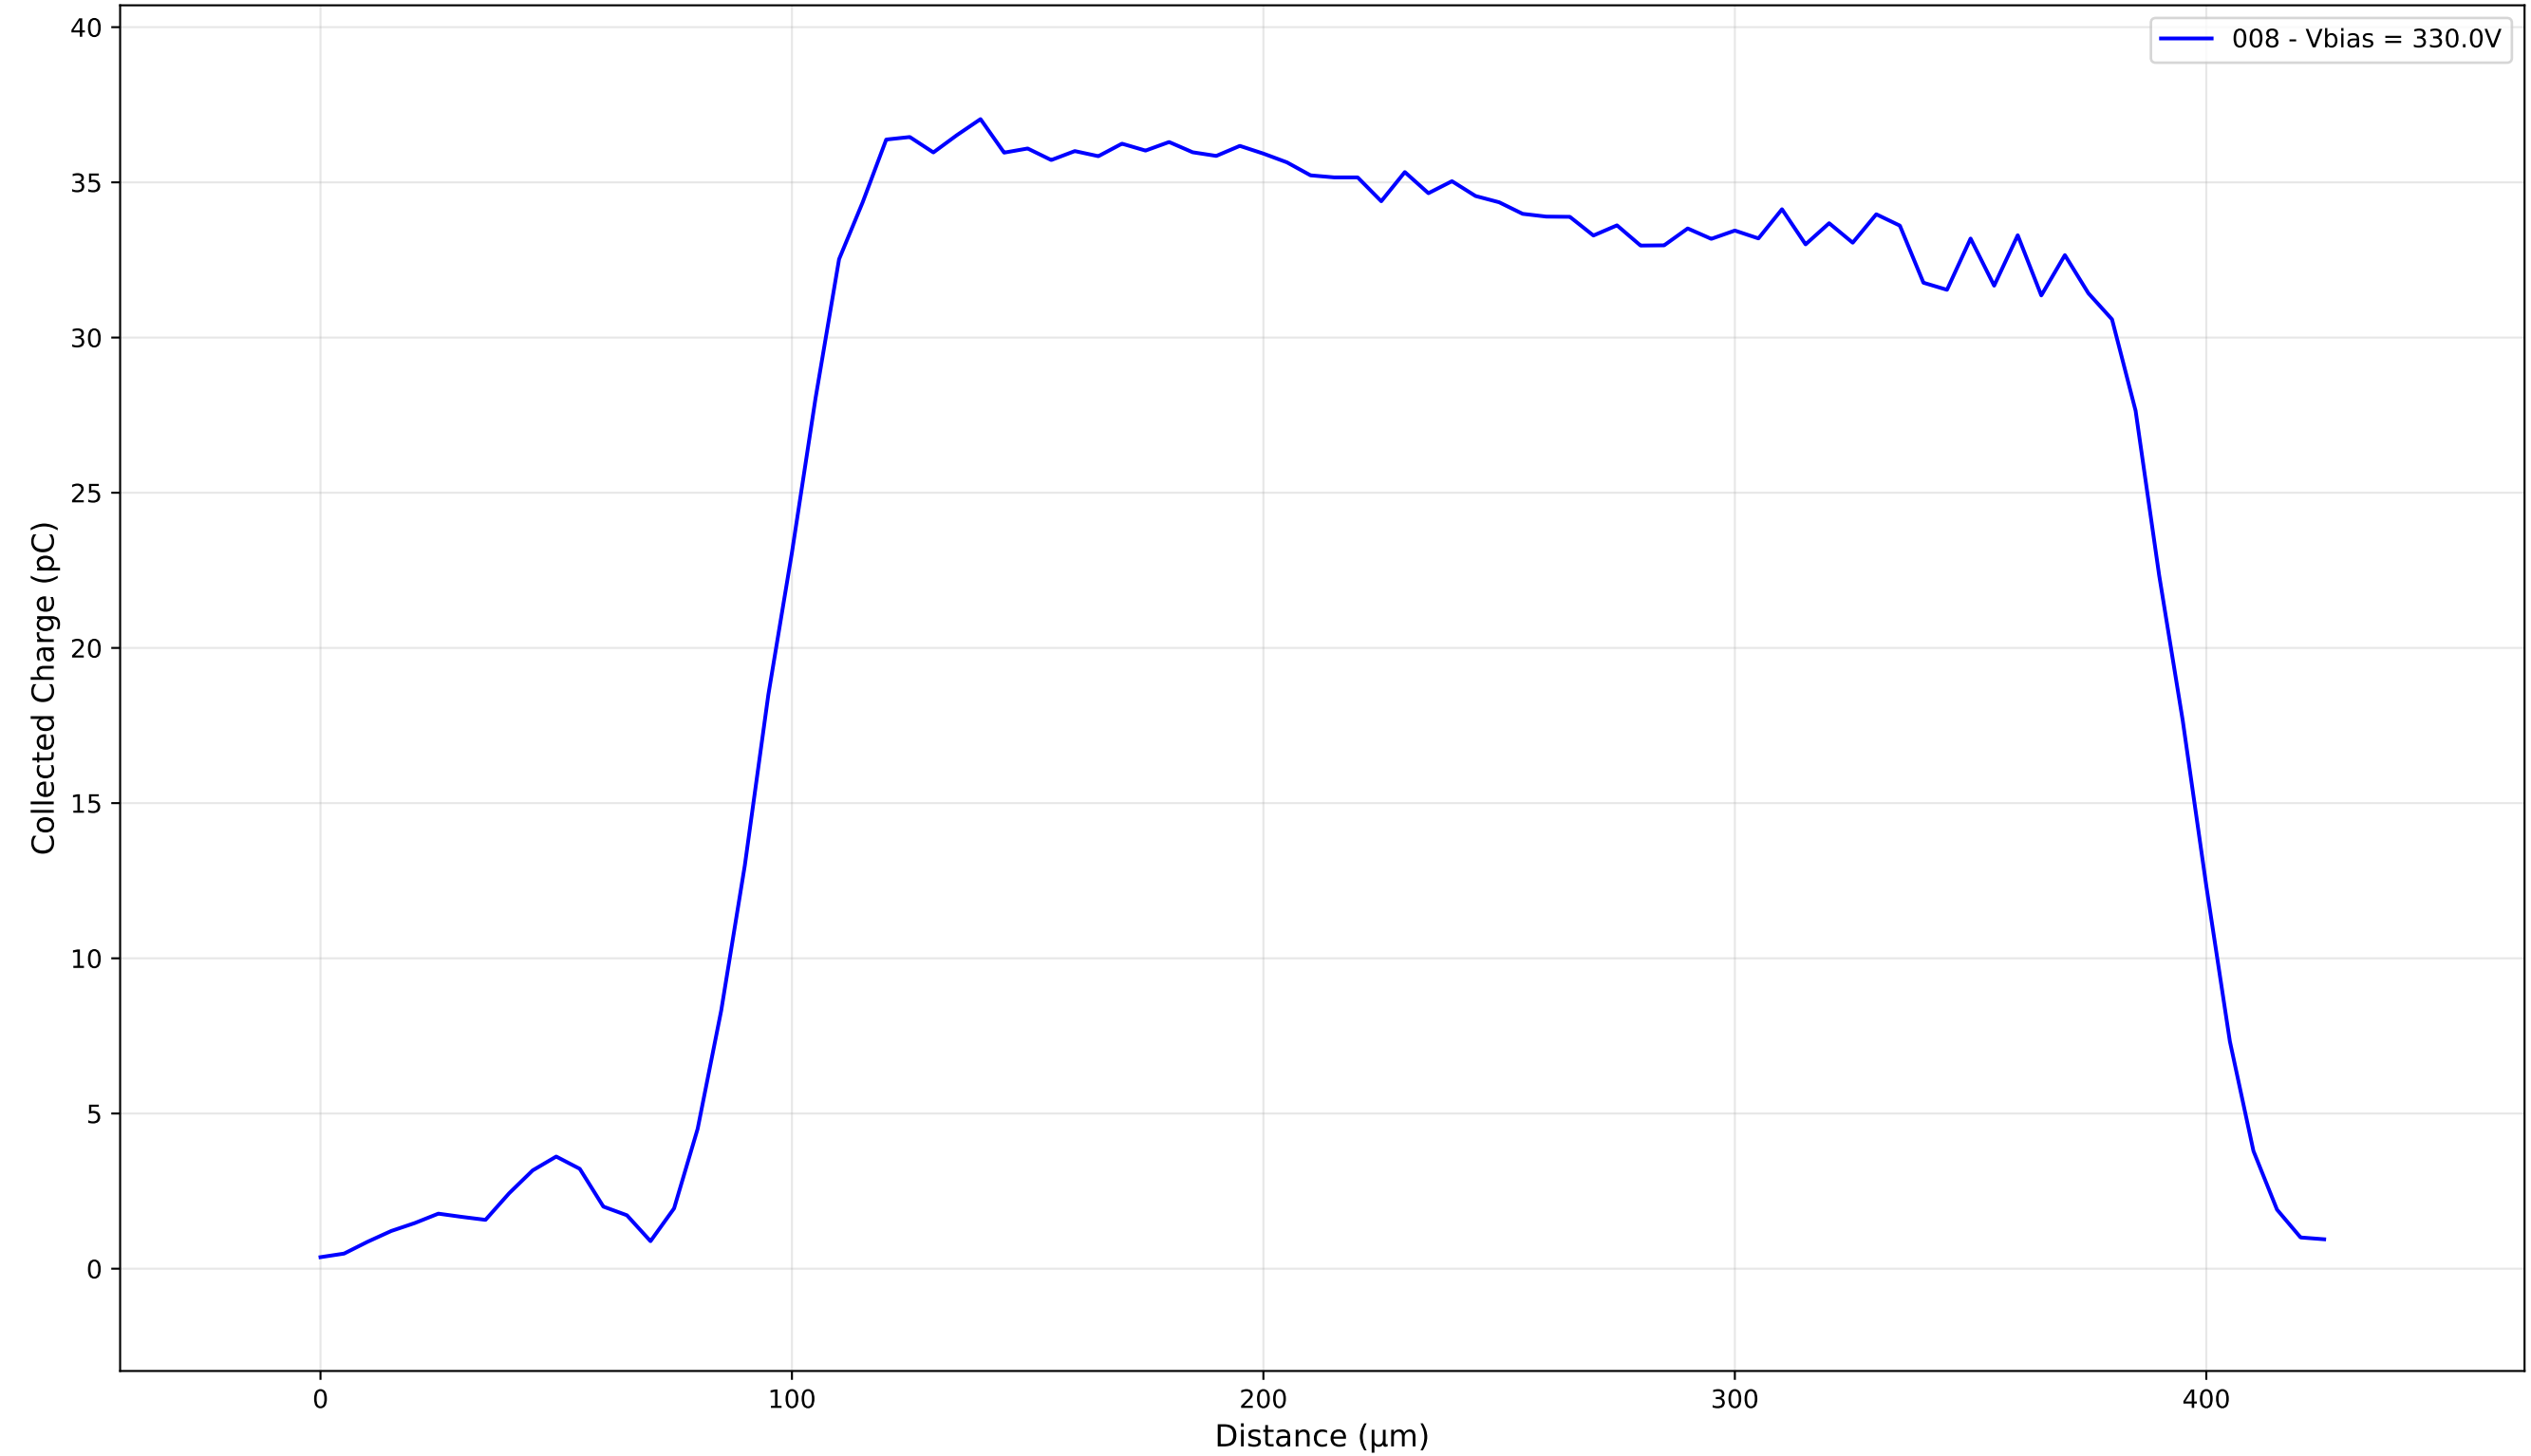

Collected Charge

008 - Vbias = 330.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

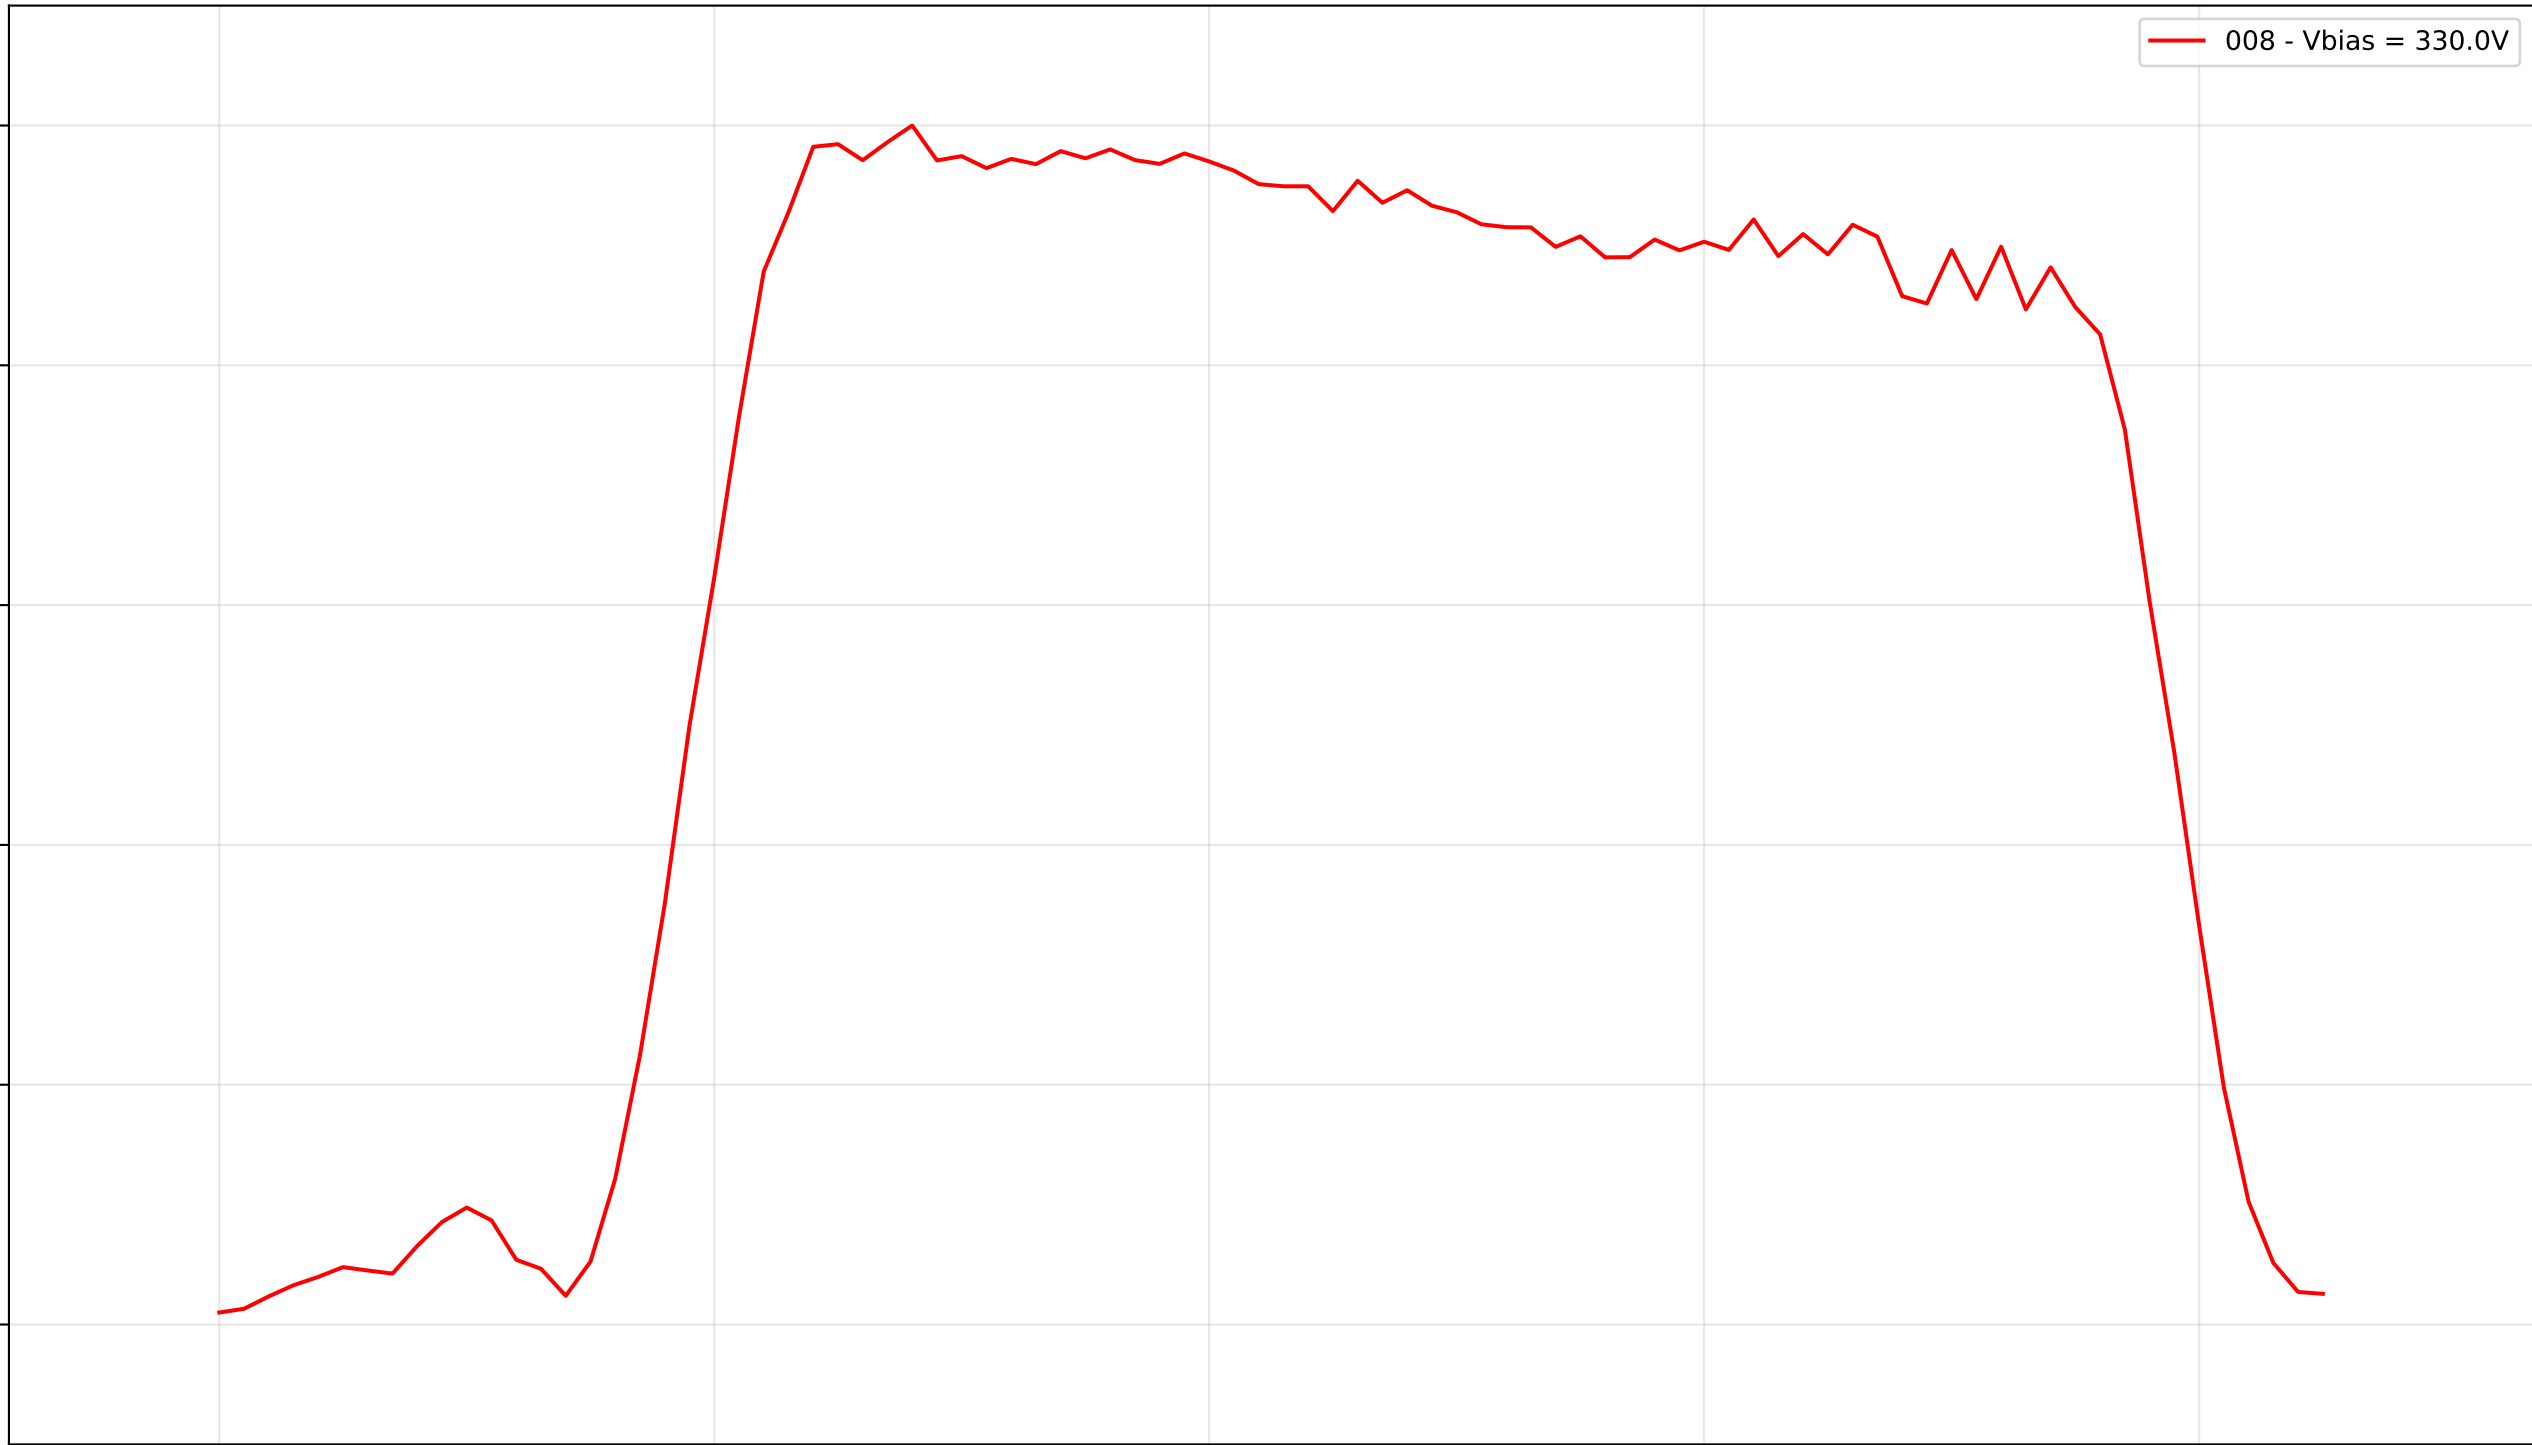


Rise Time

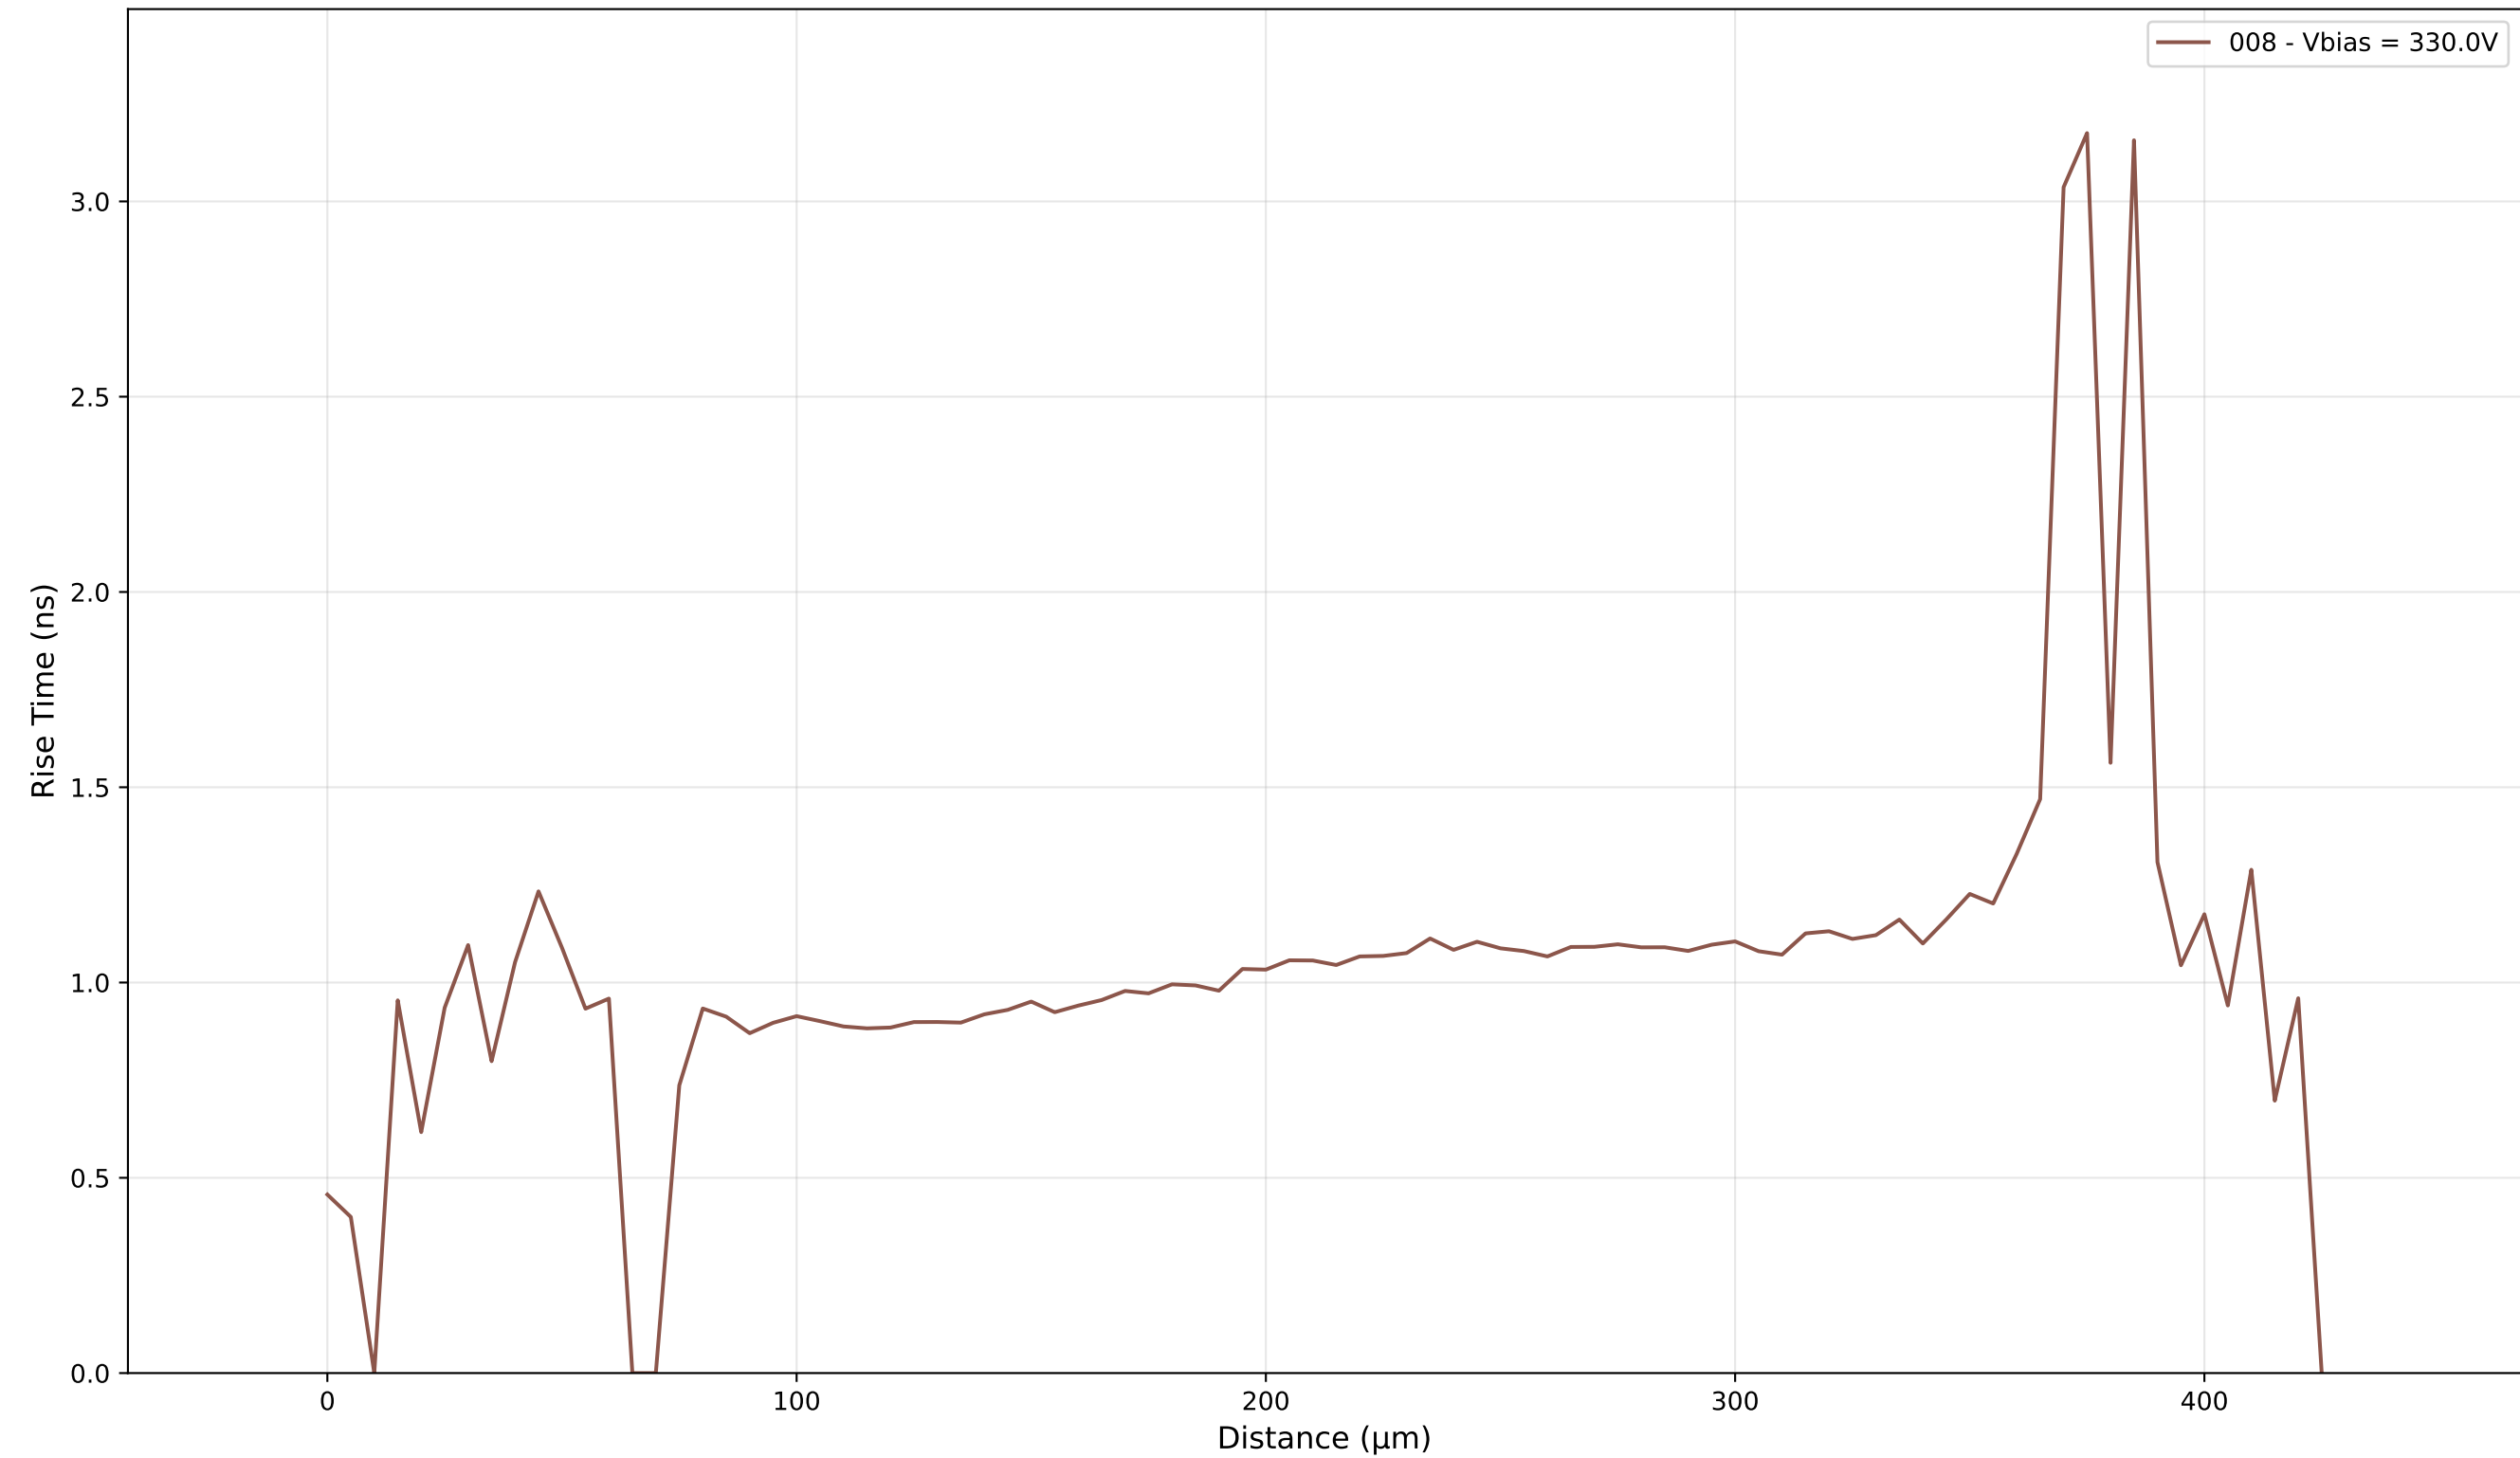


Amplitude

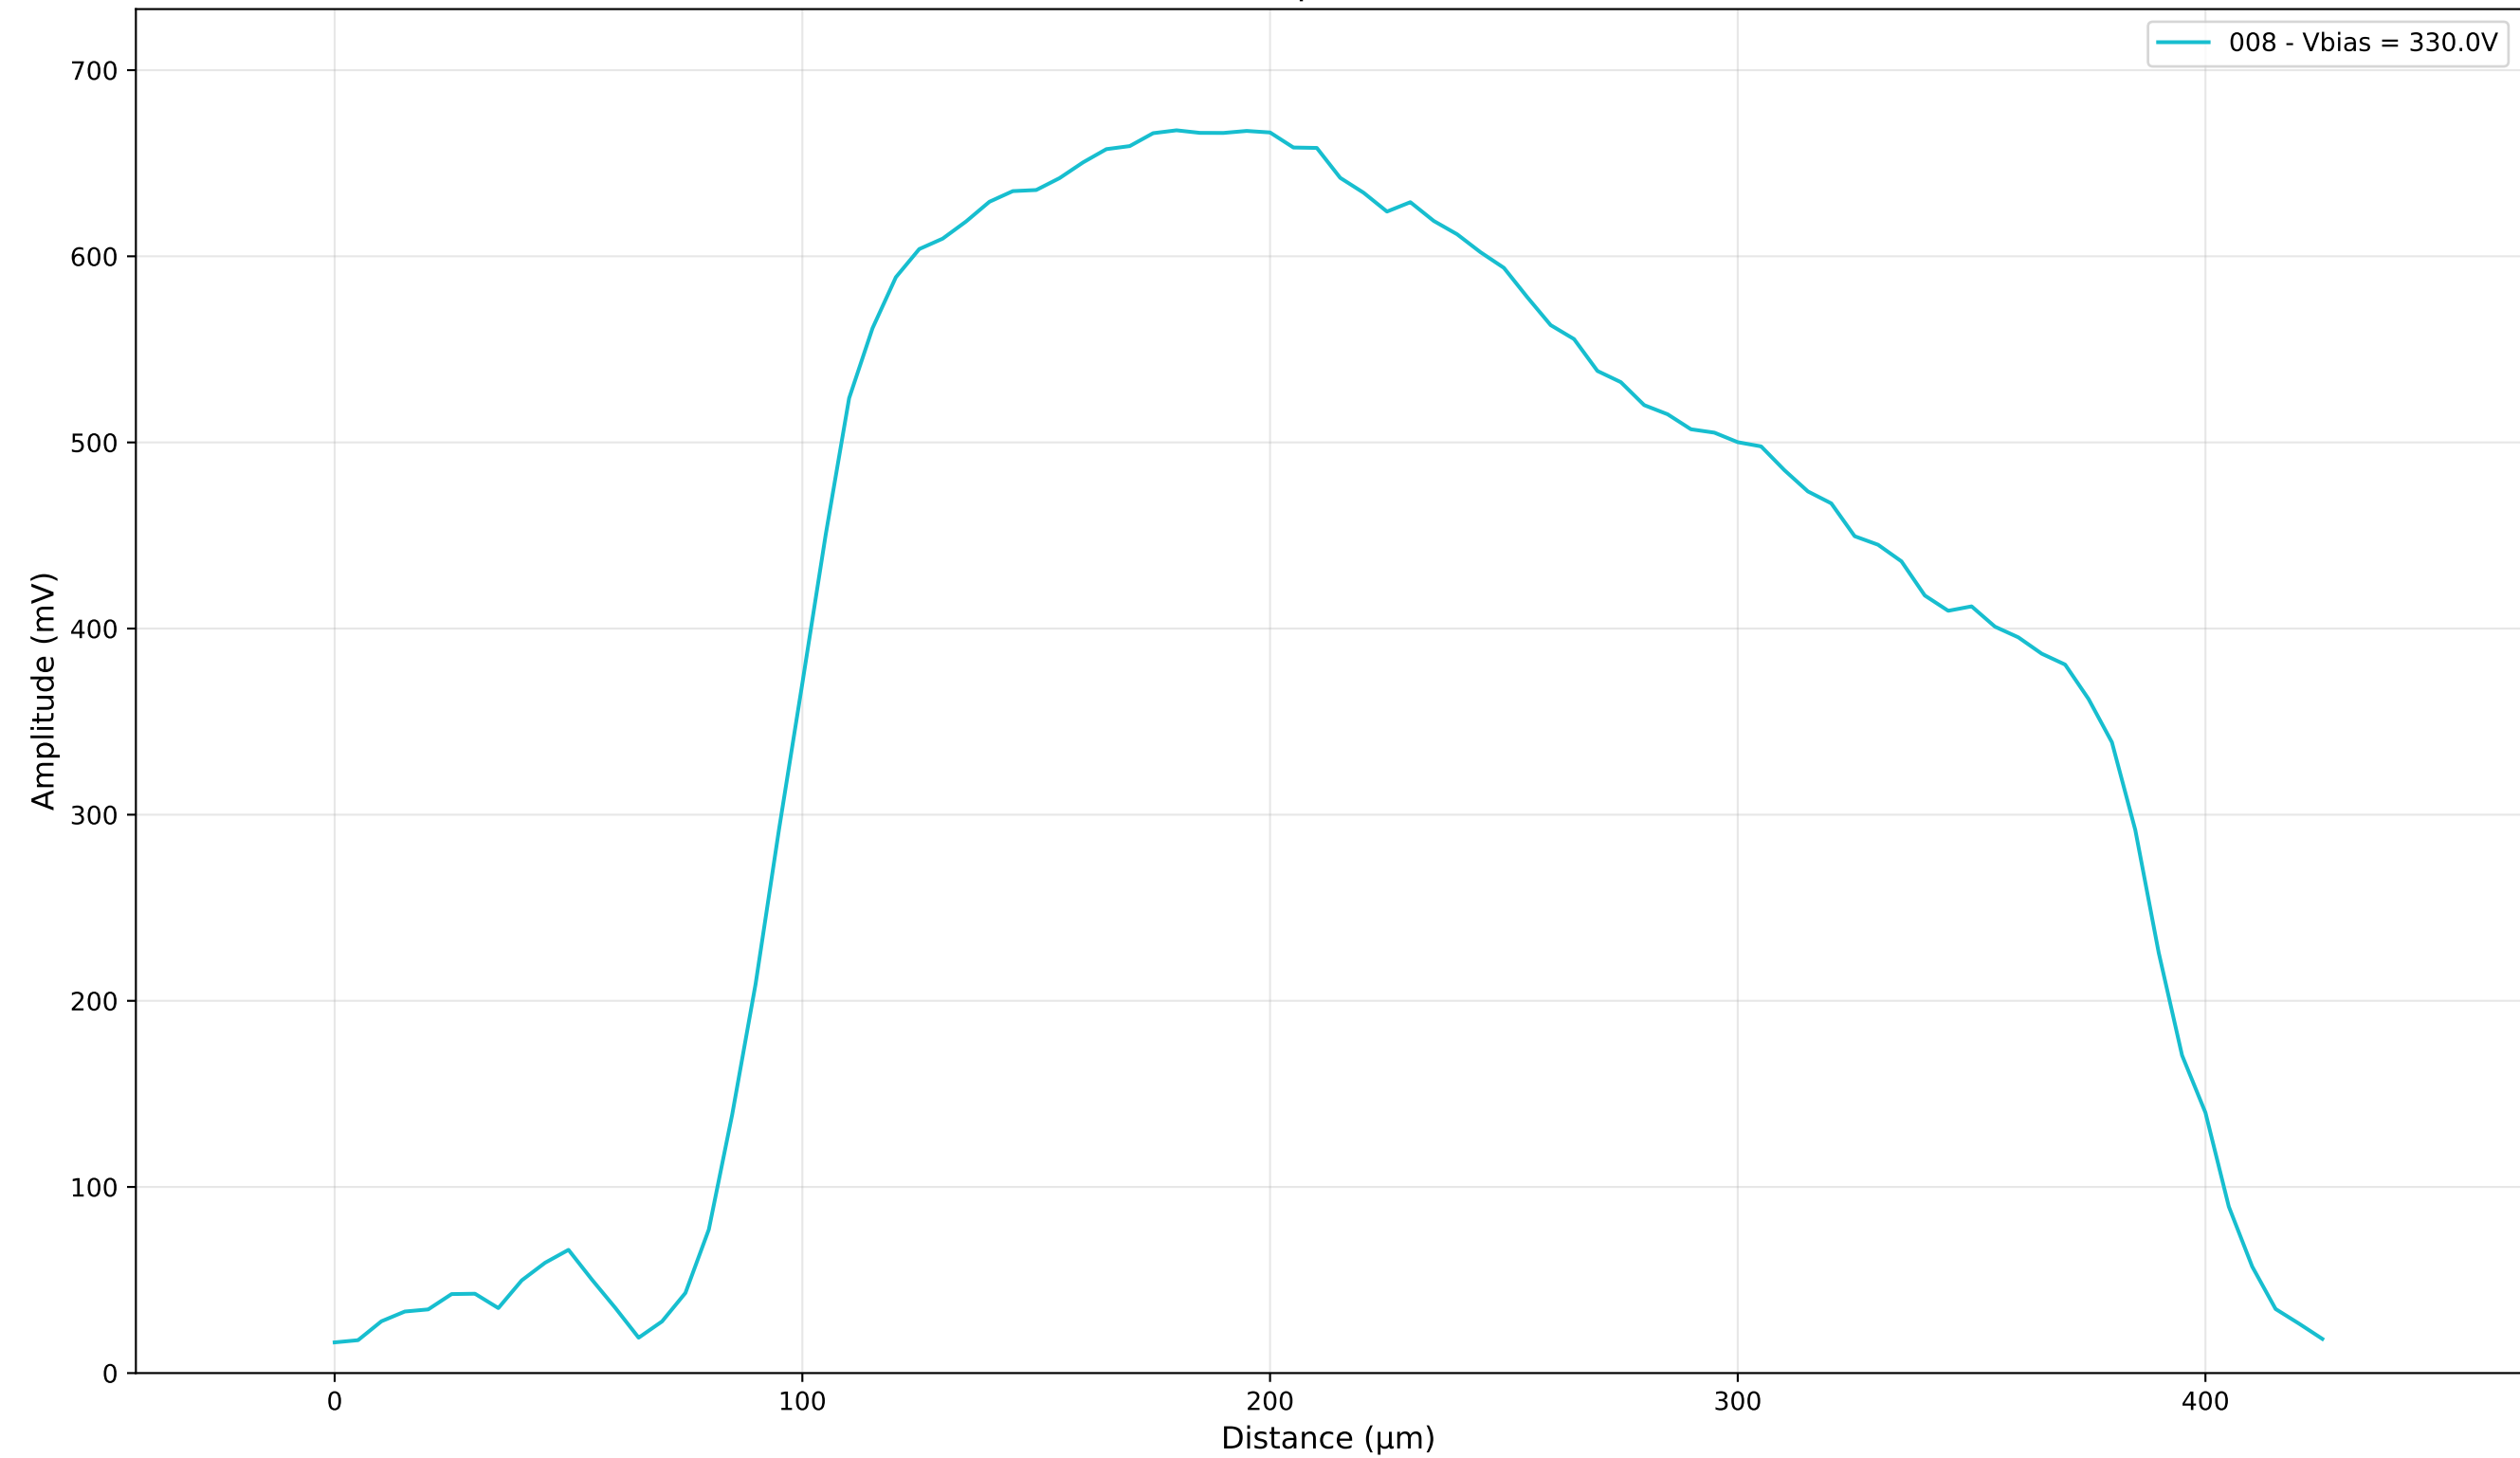


FWHM

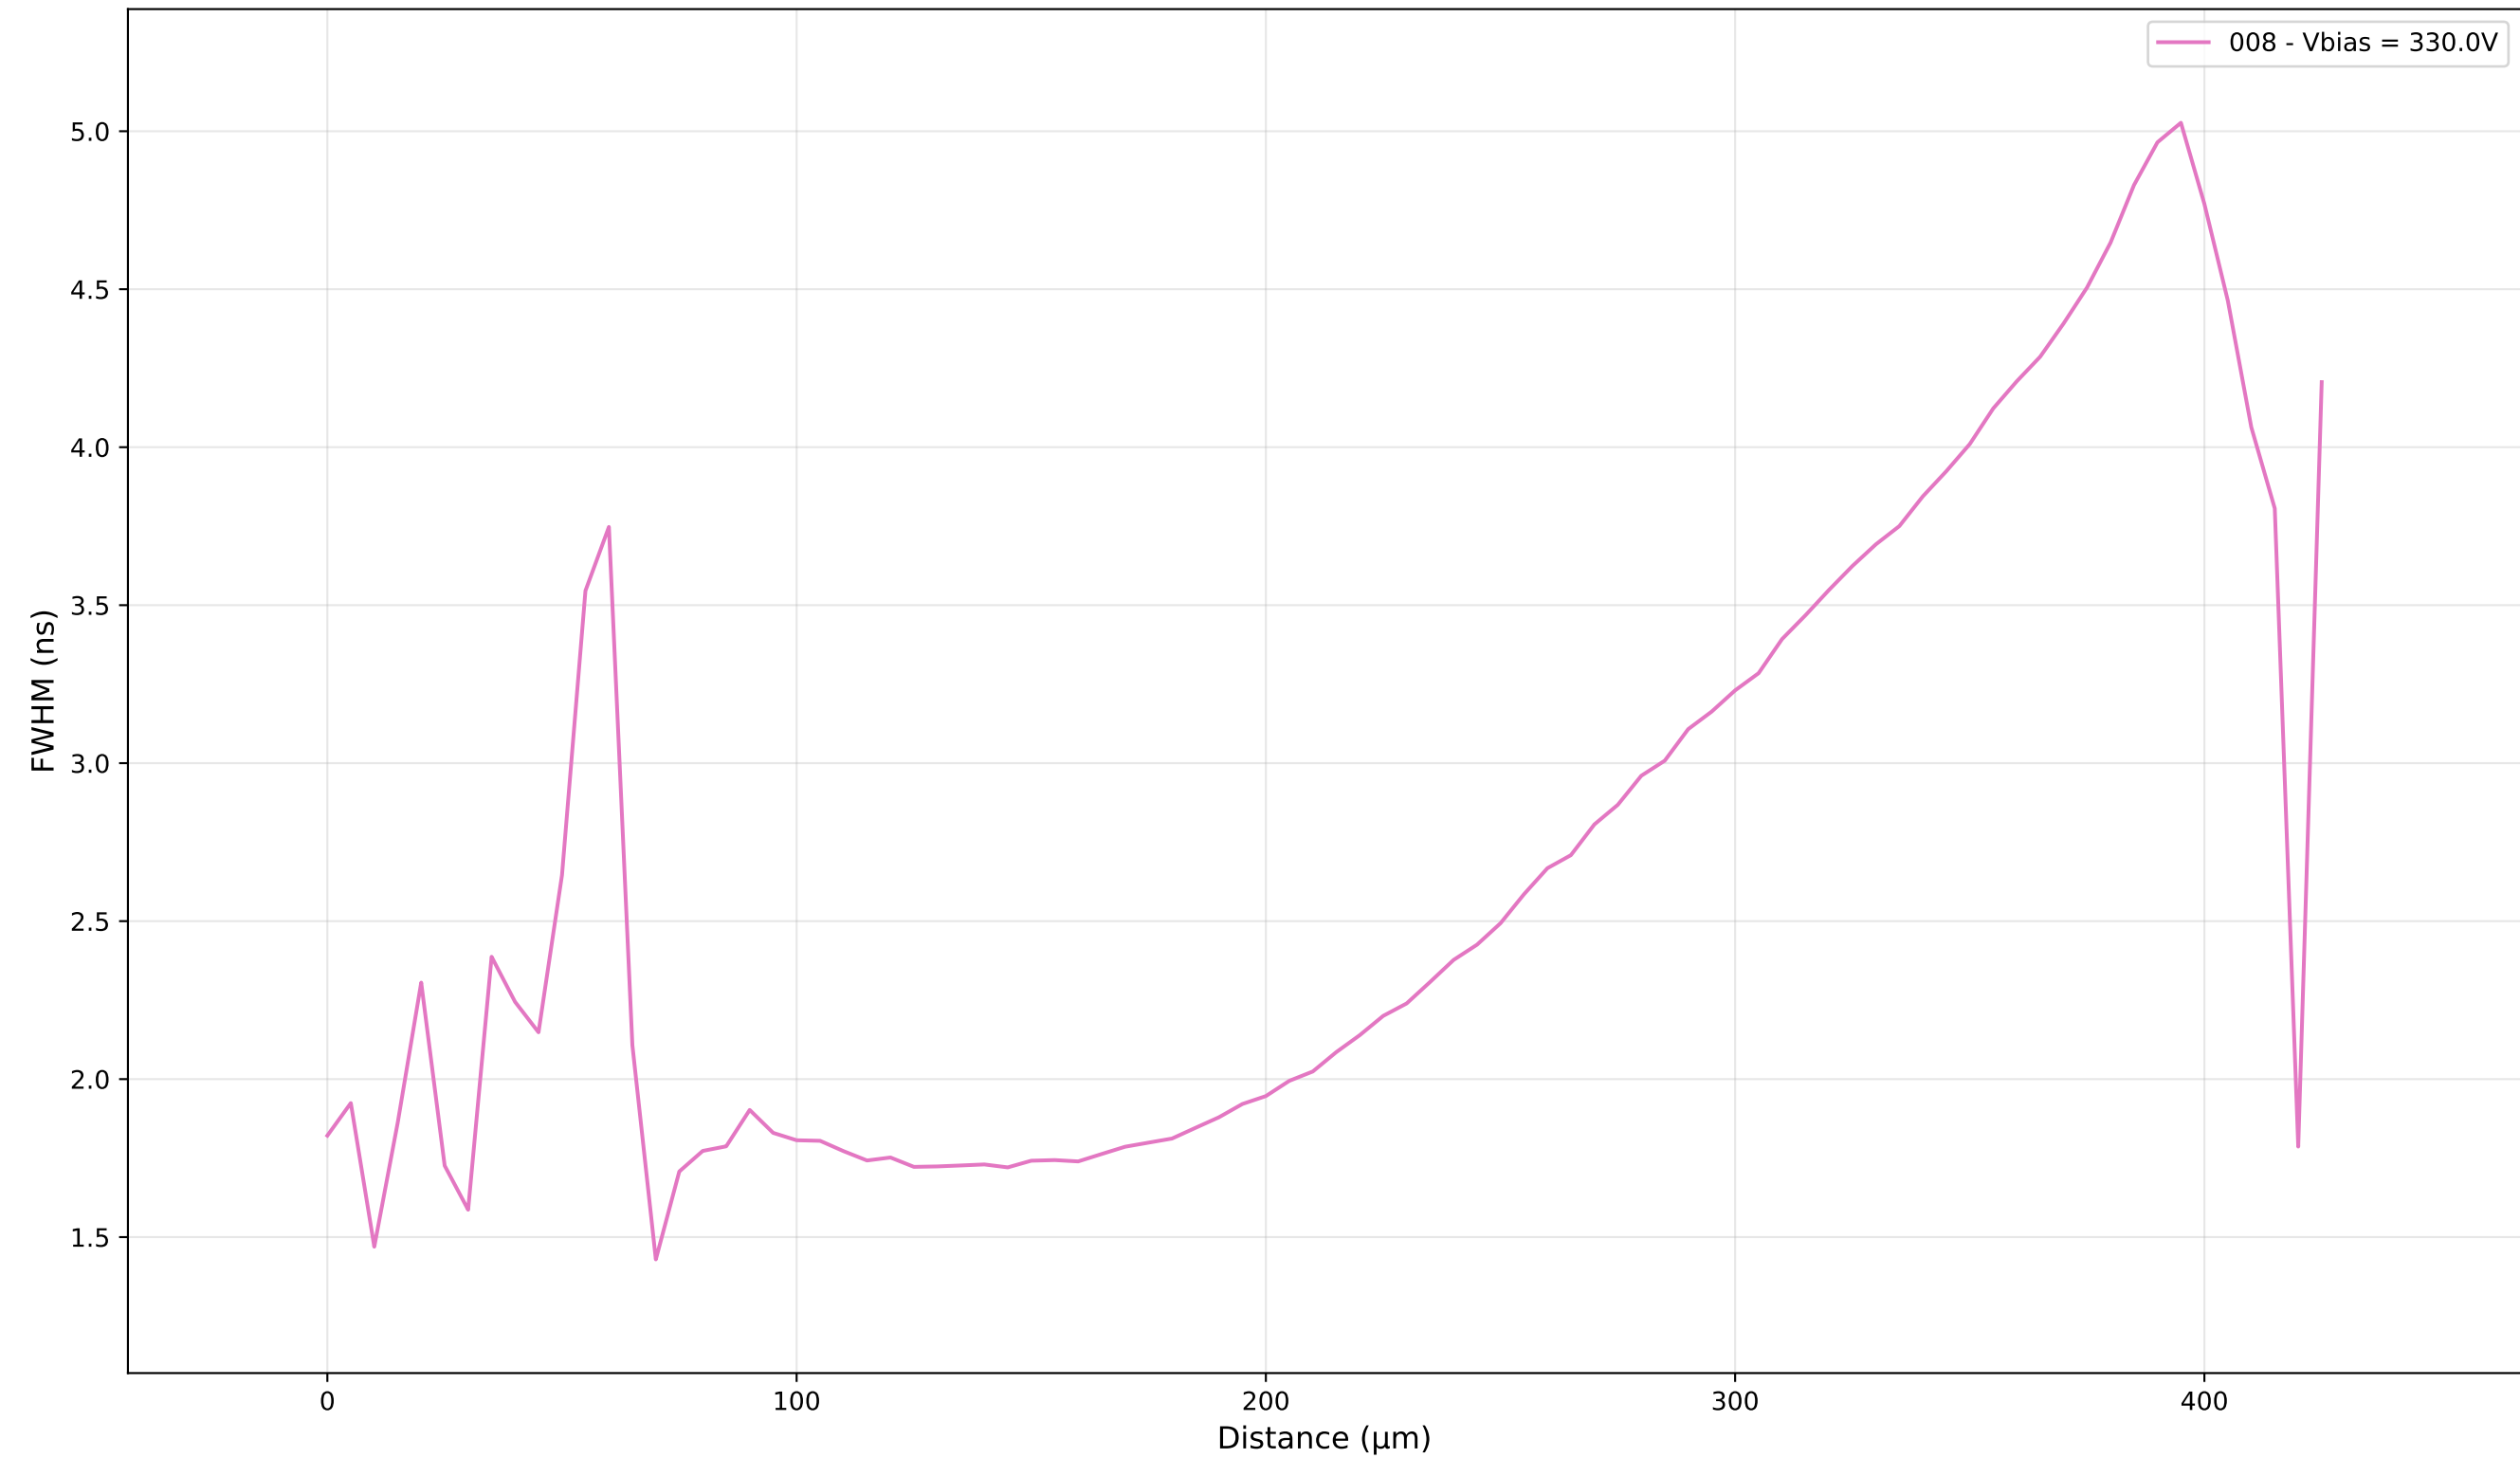


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.37 pC - Rise Time: 0.46 ns

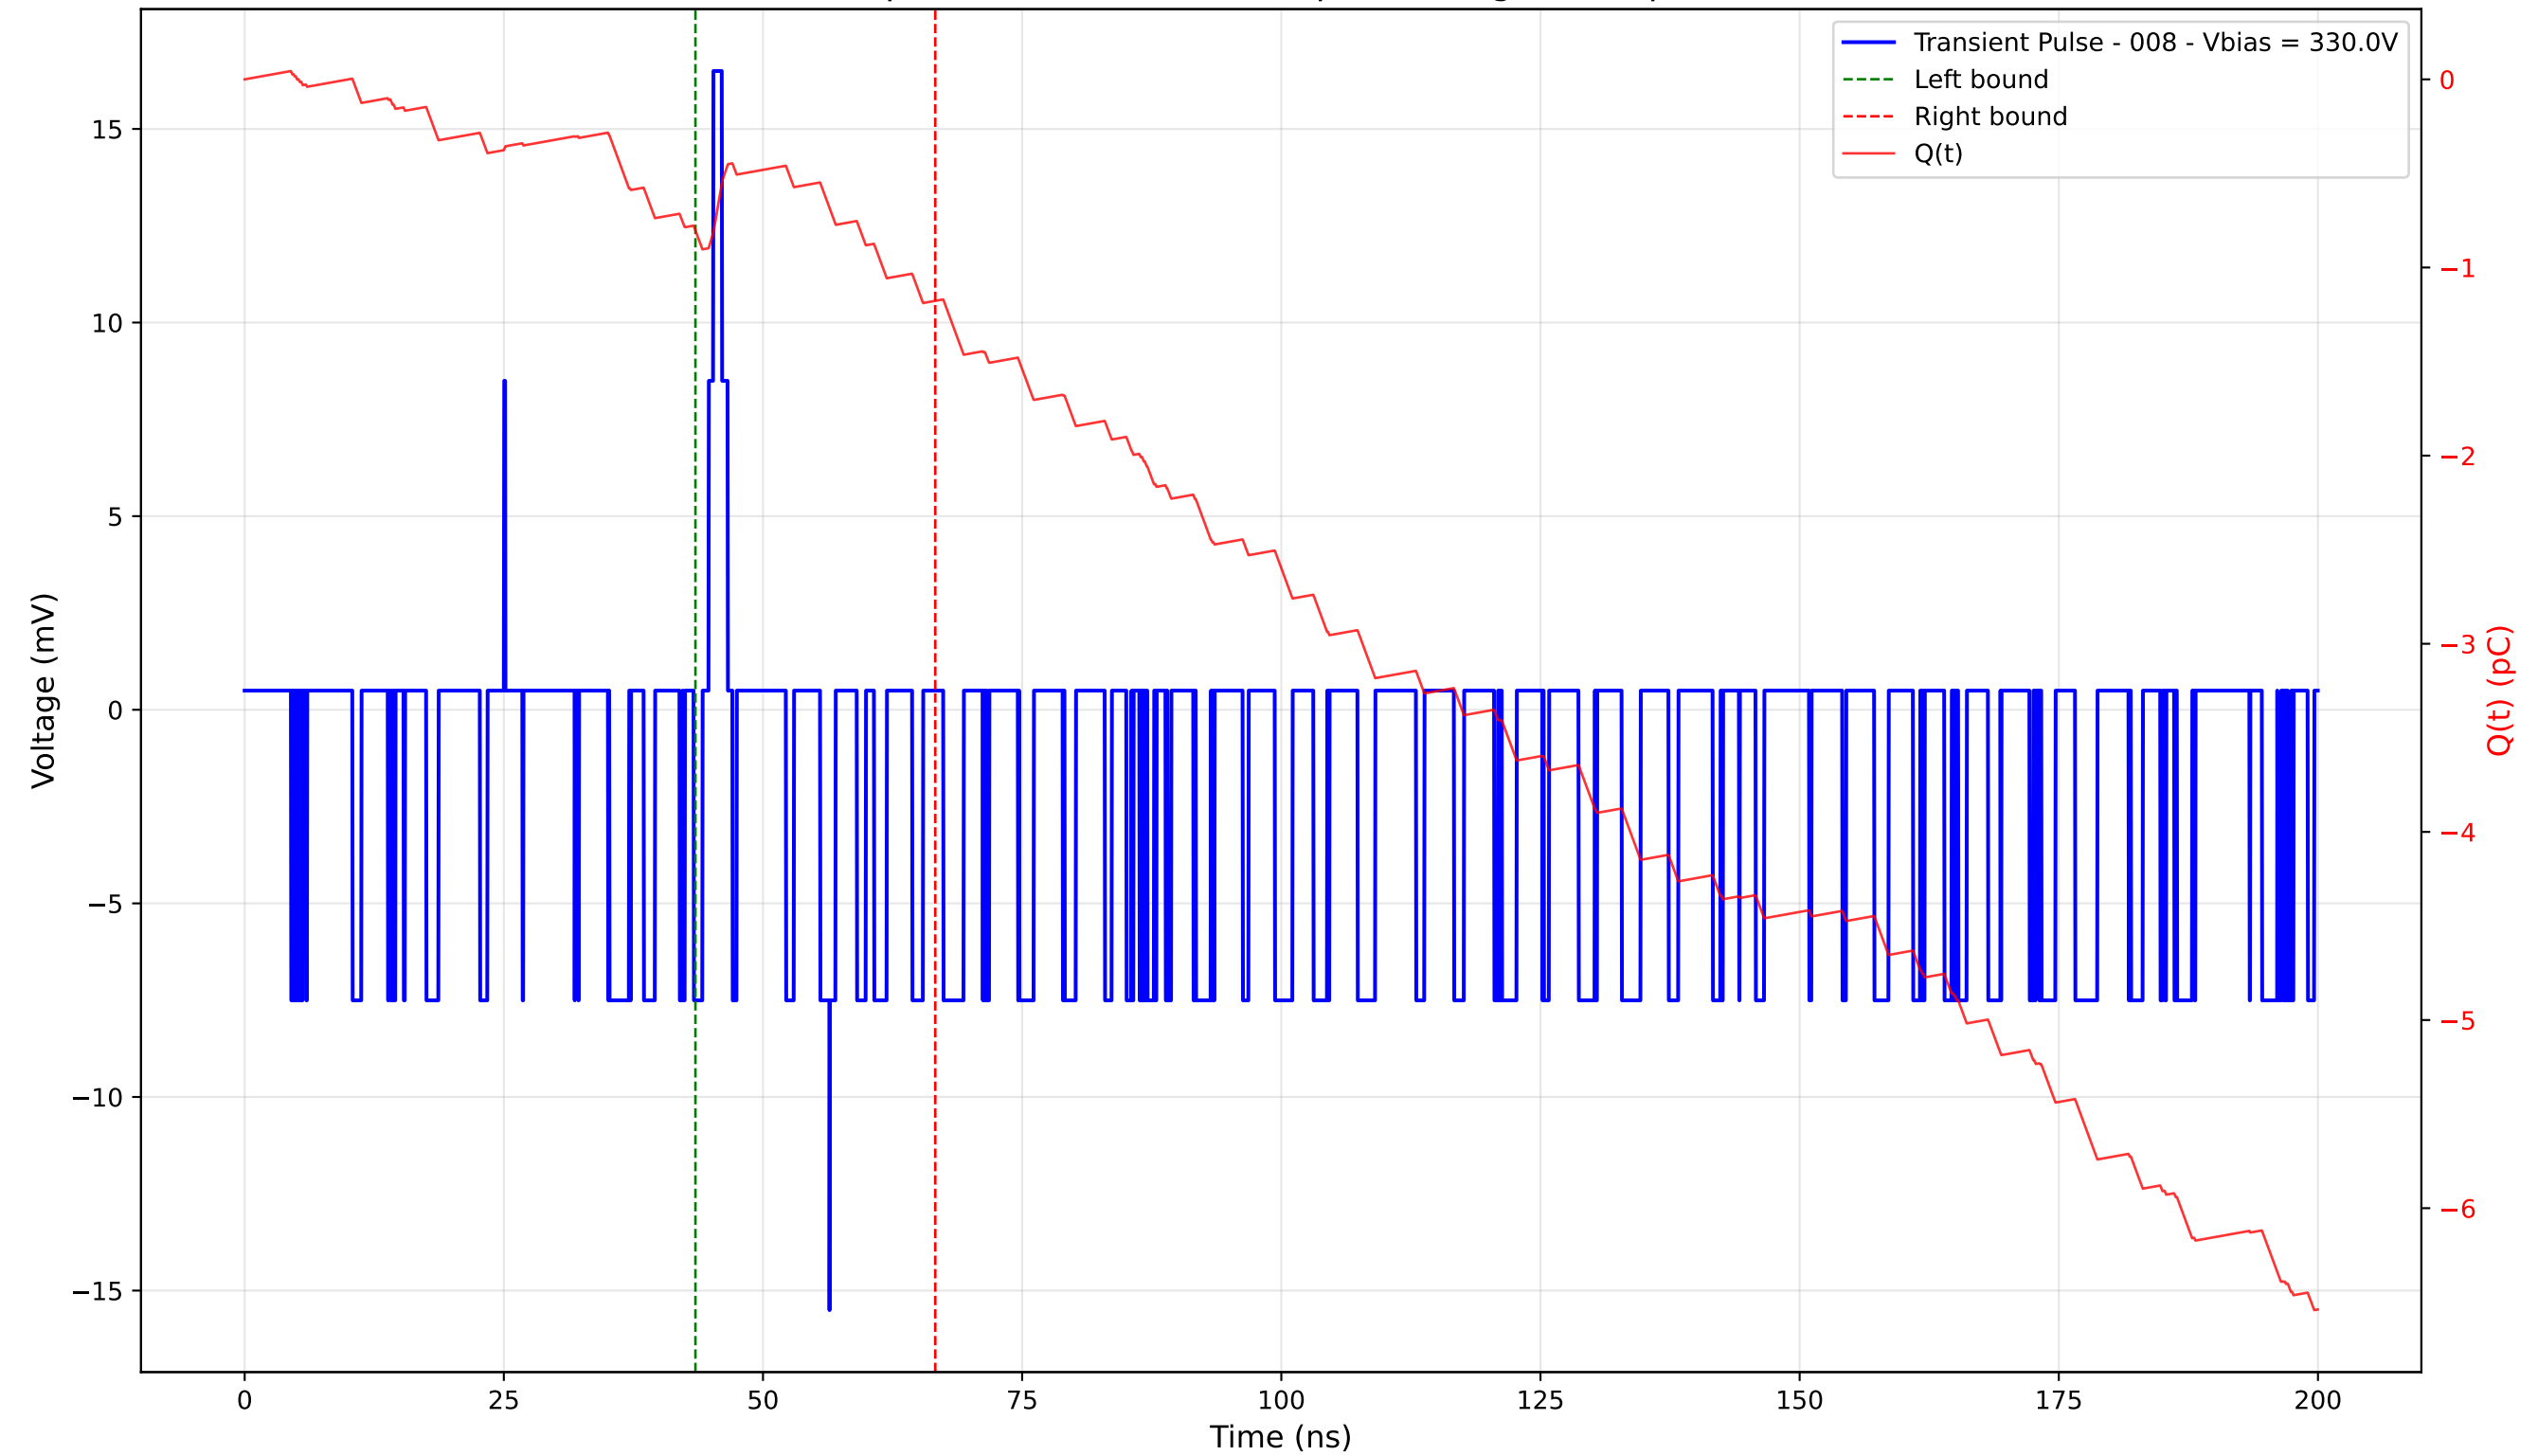


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.49 pC - Rise Time: 0.40 ns

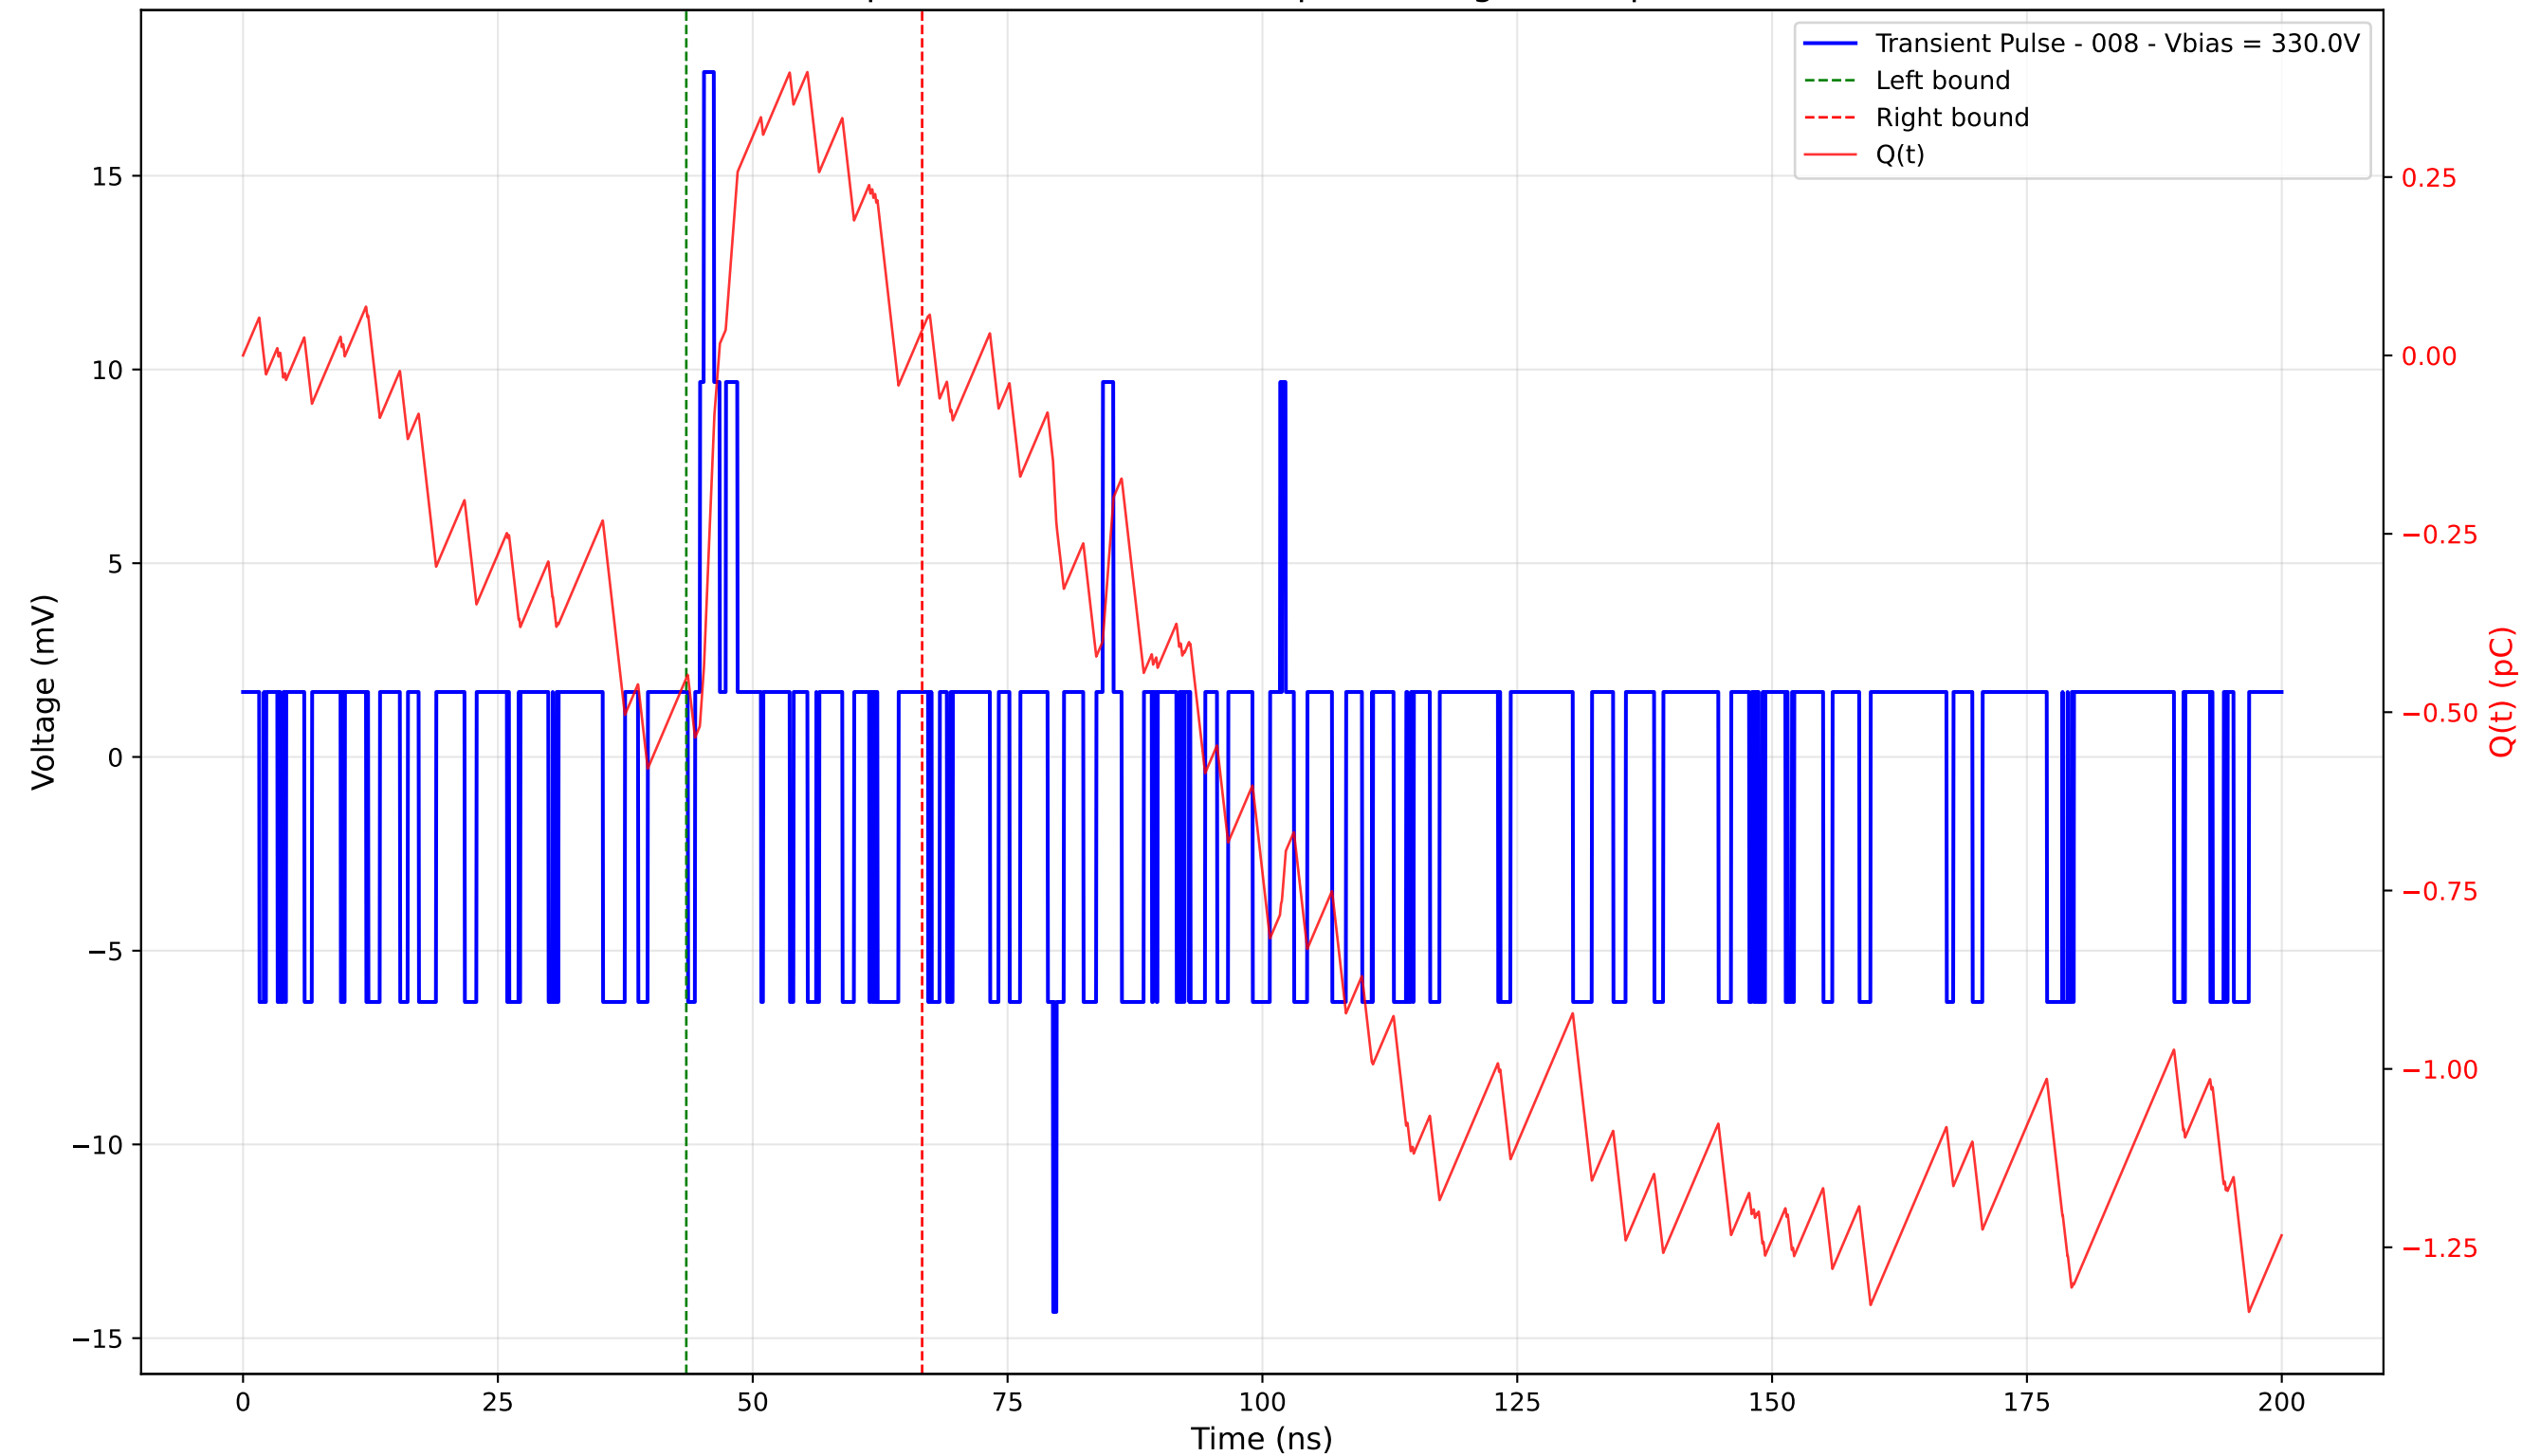


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.87 pC - Rise Time: 0.00 ns (N/A)

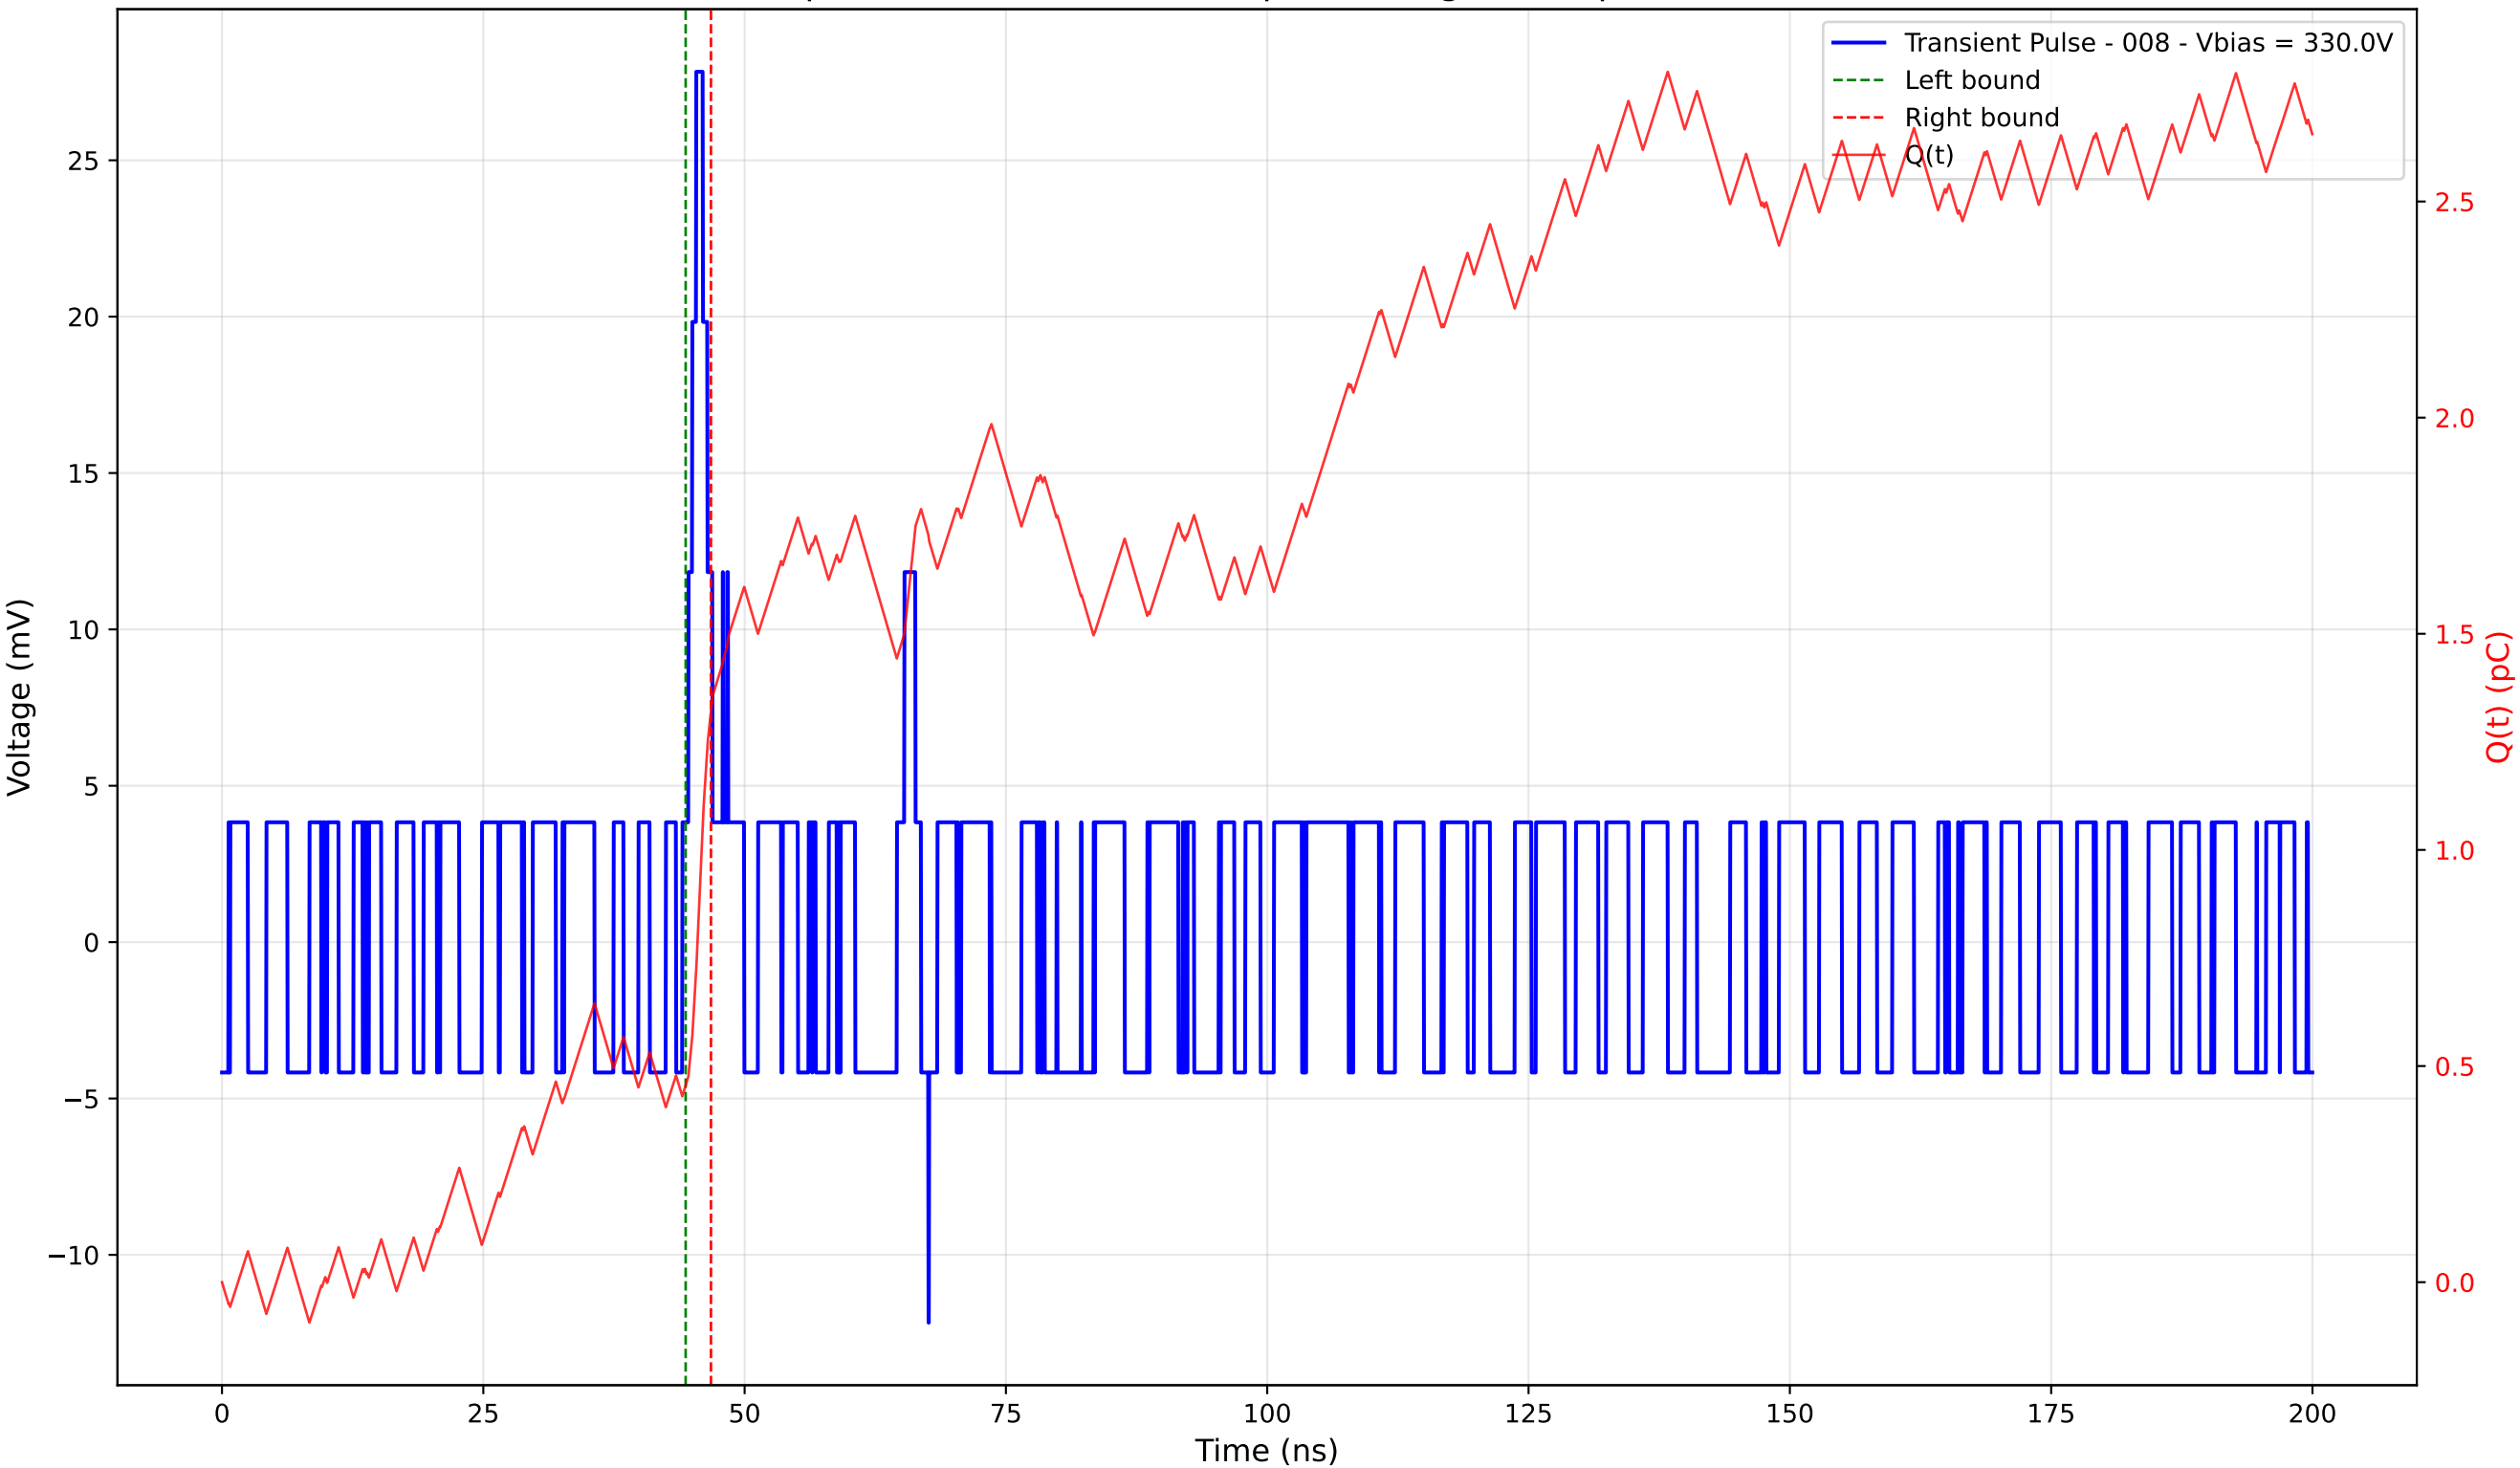


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.21 pC - Rise Time: 0.95 ns

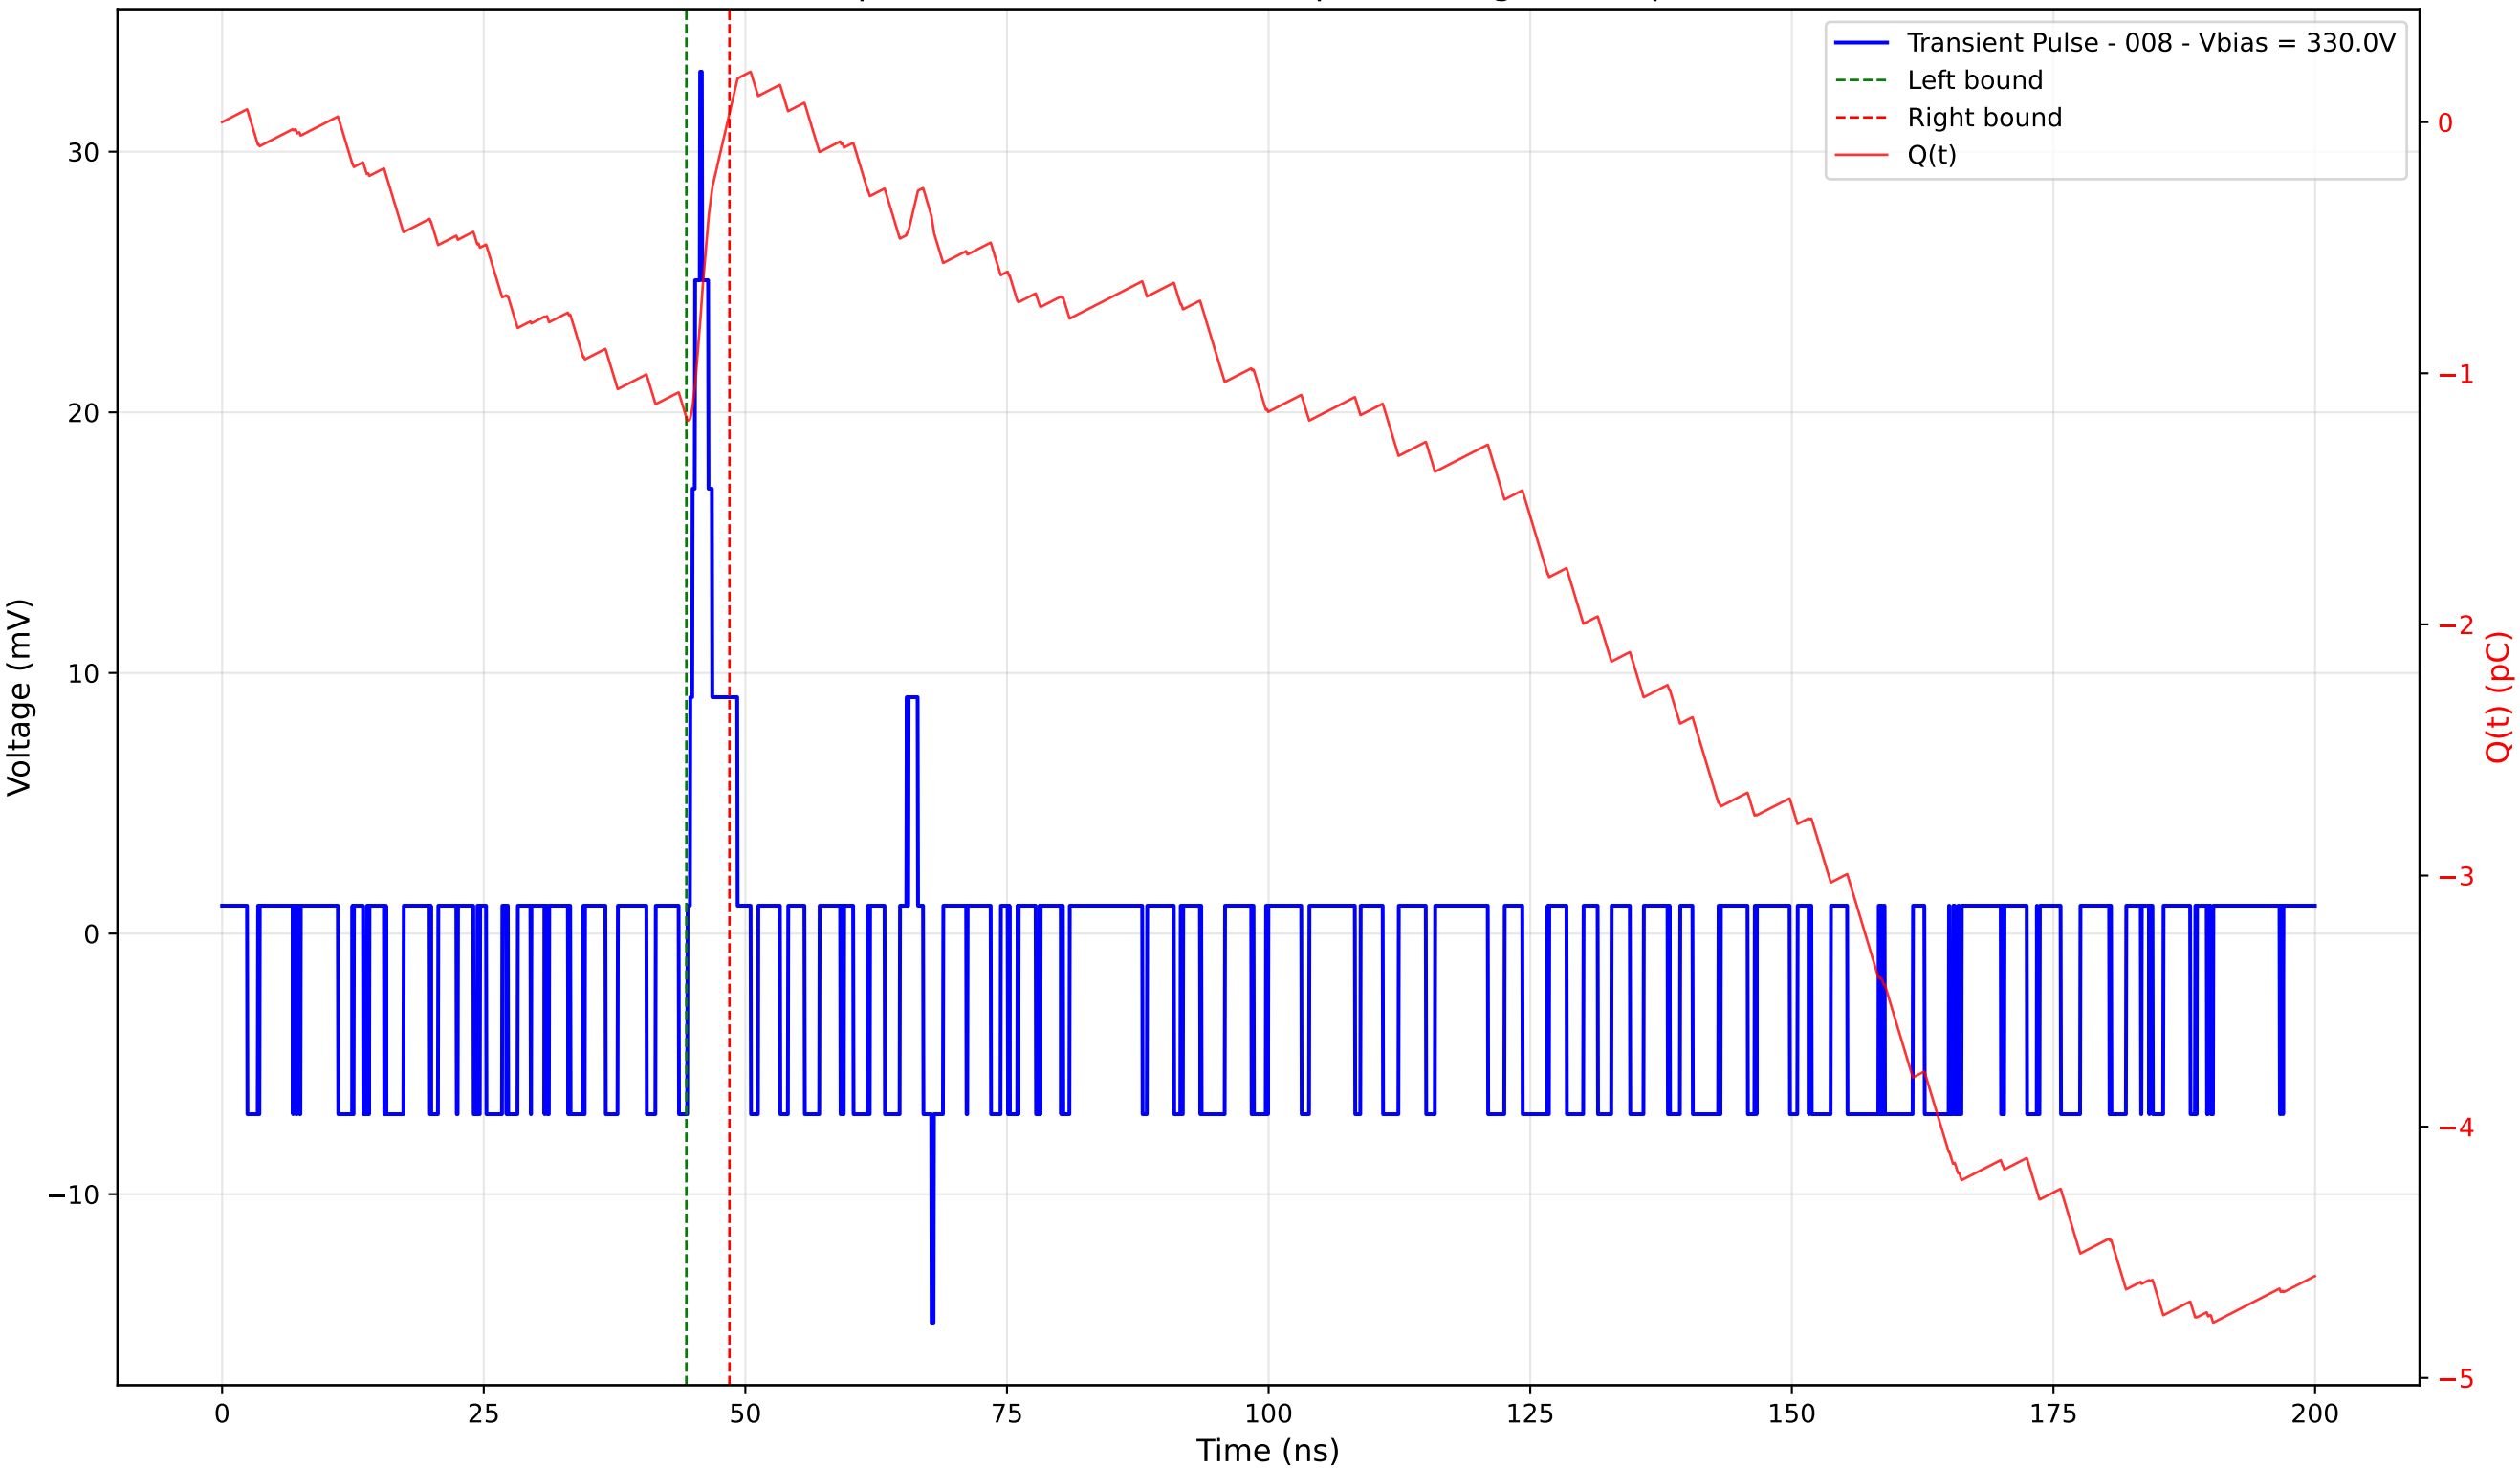


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.47 pC - Rise Time: 0.62 ns

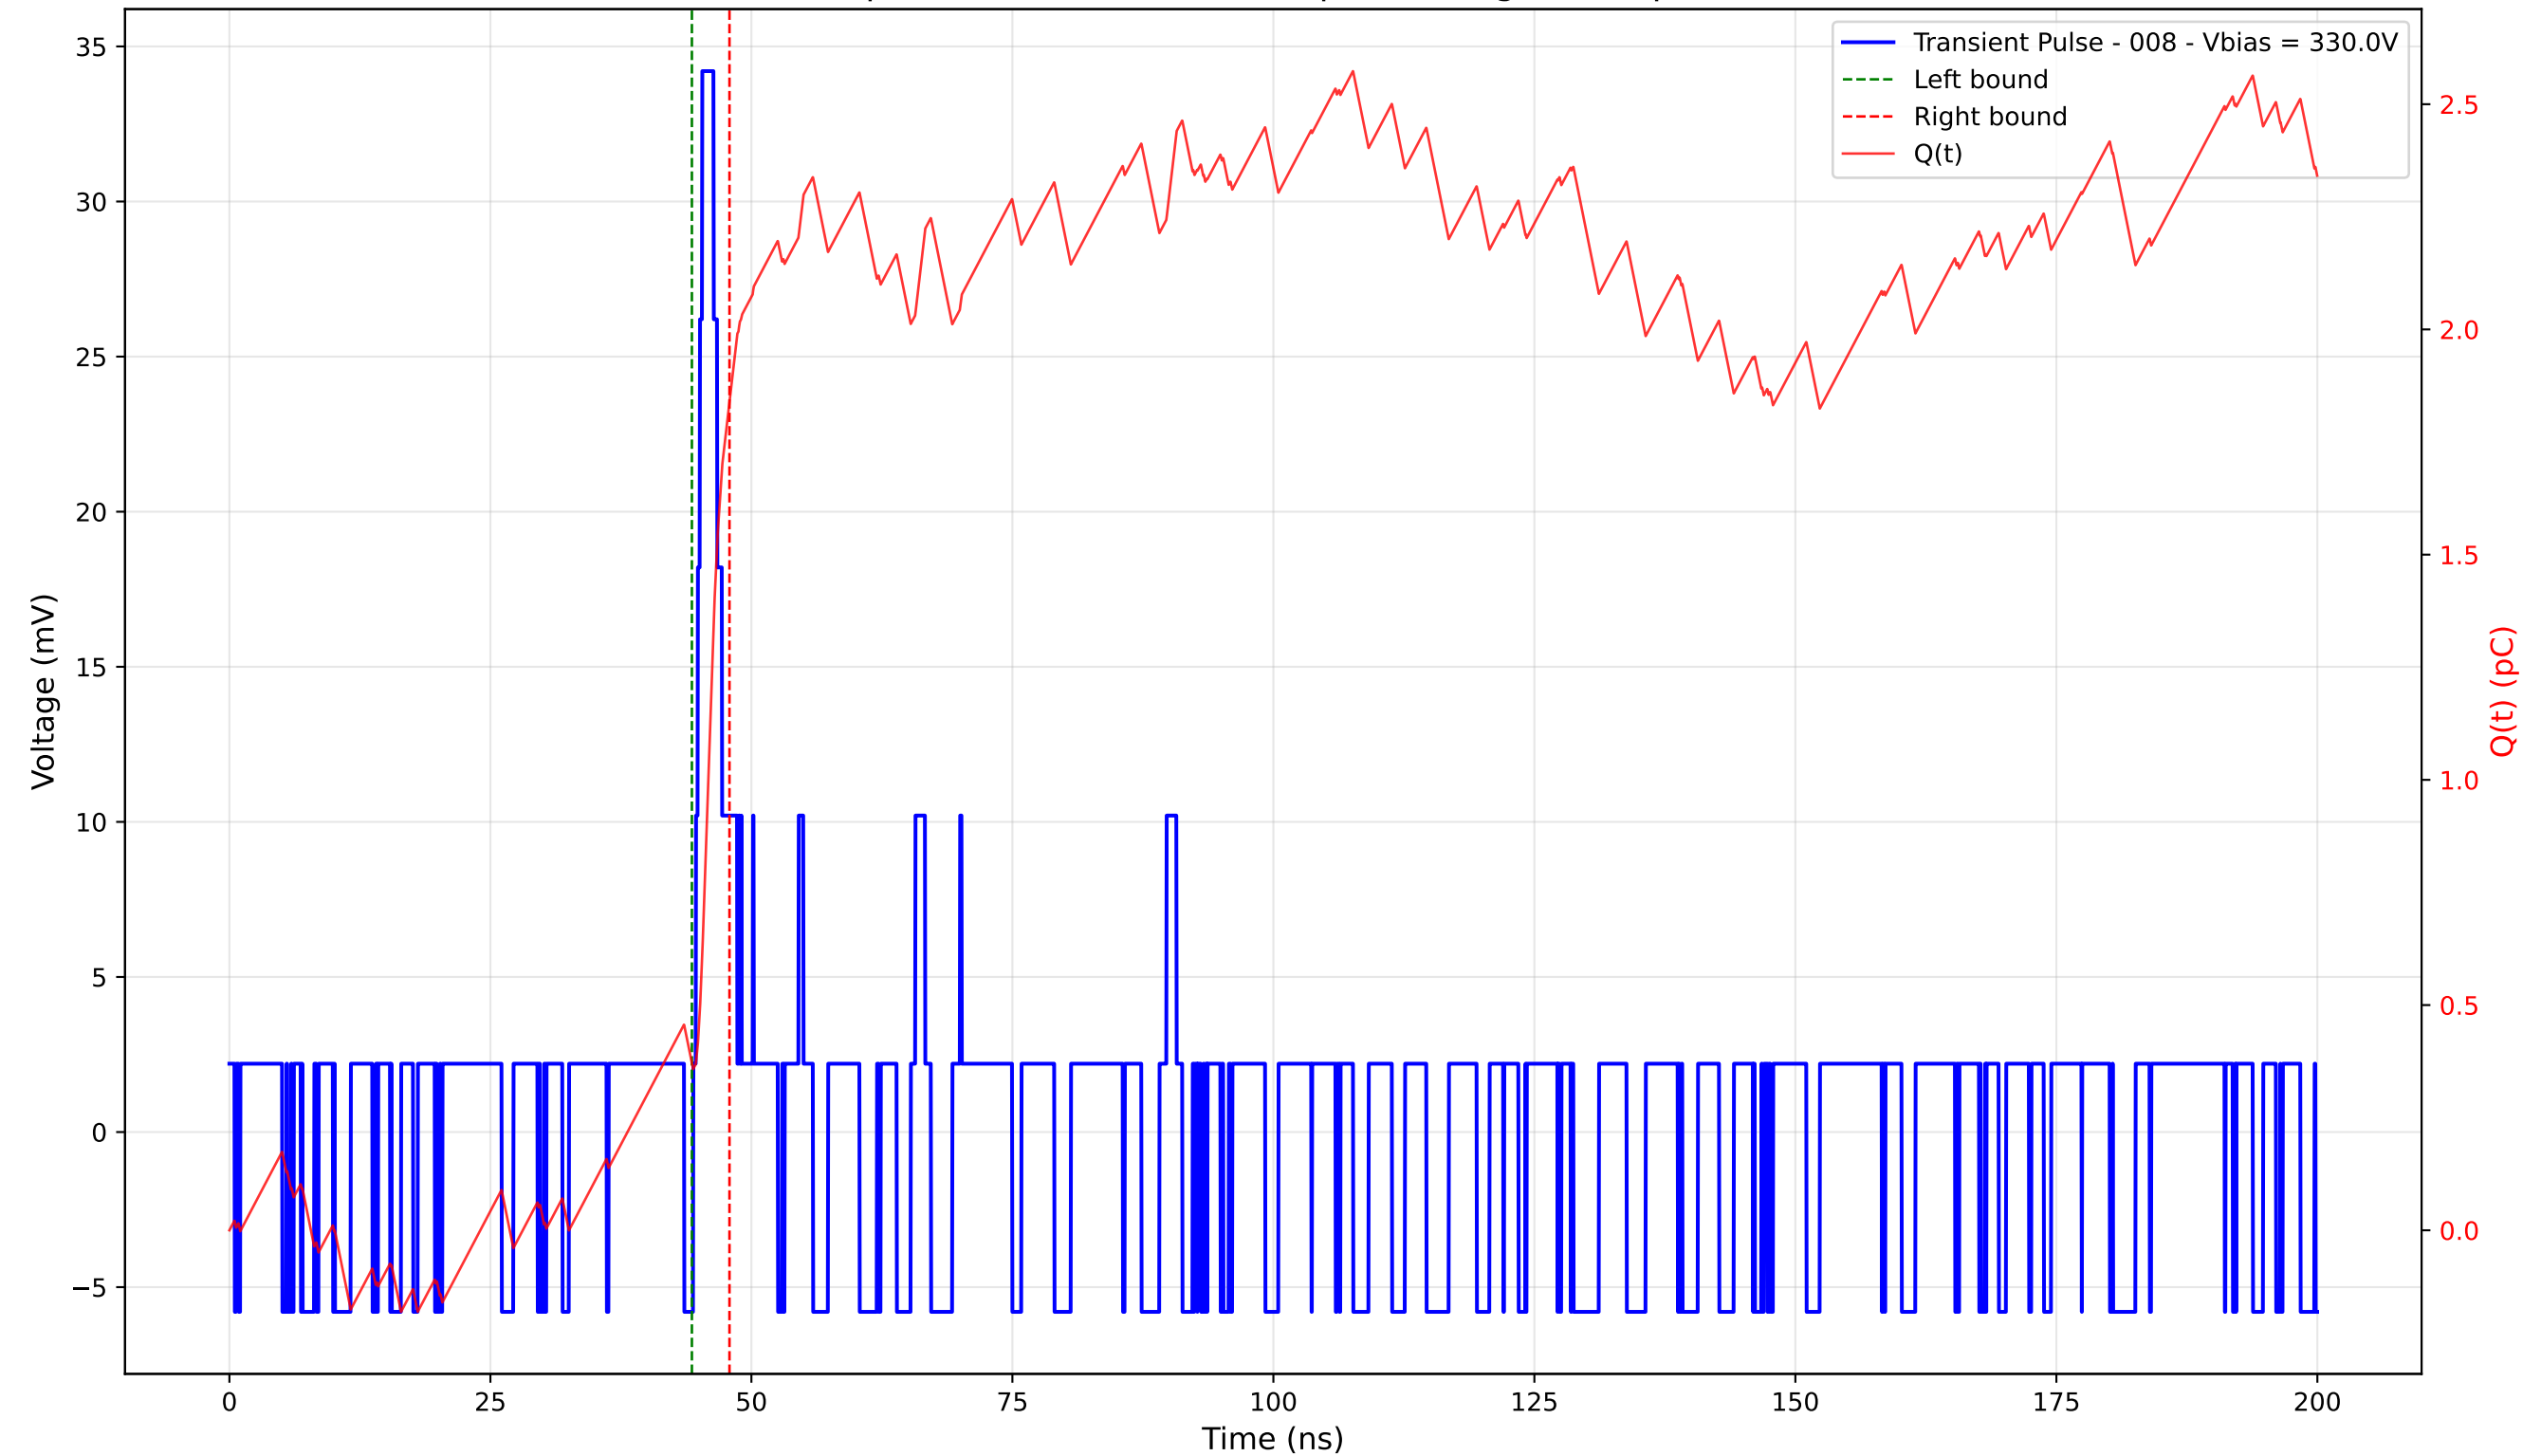


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.77 pC - Rise Time: 0.94 ns

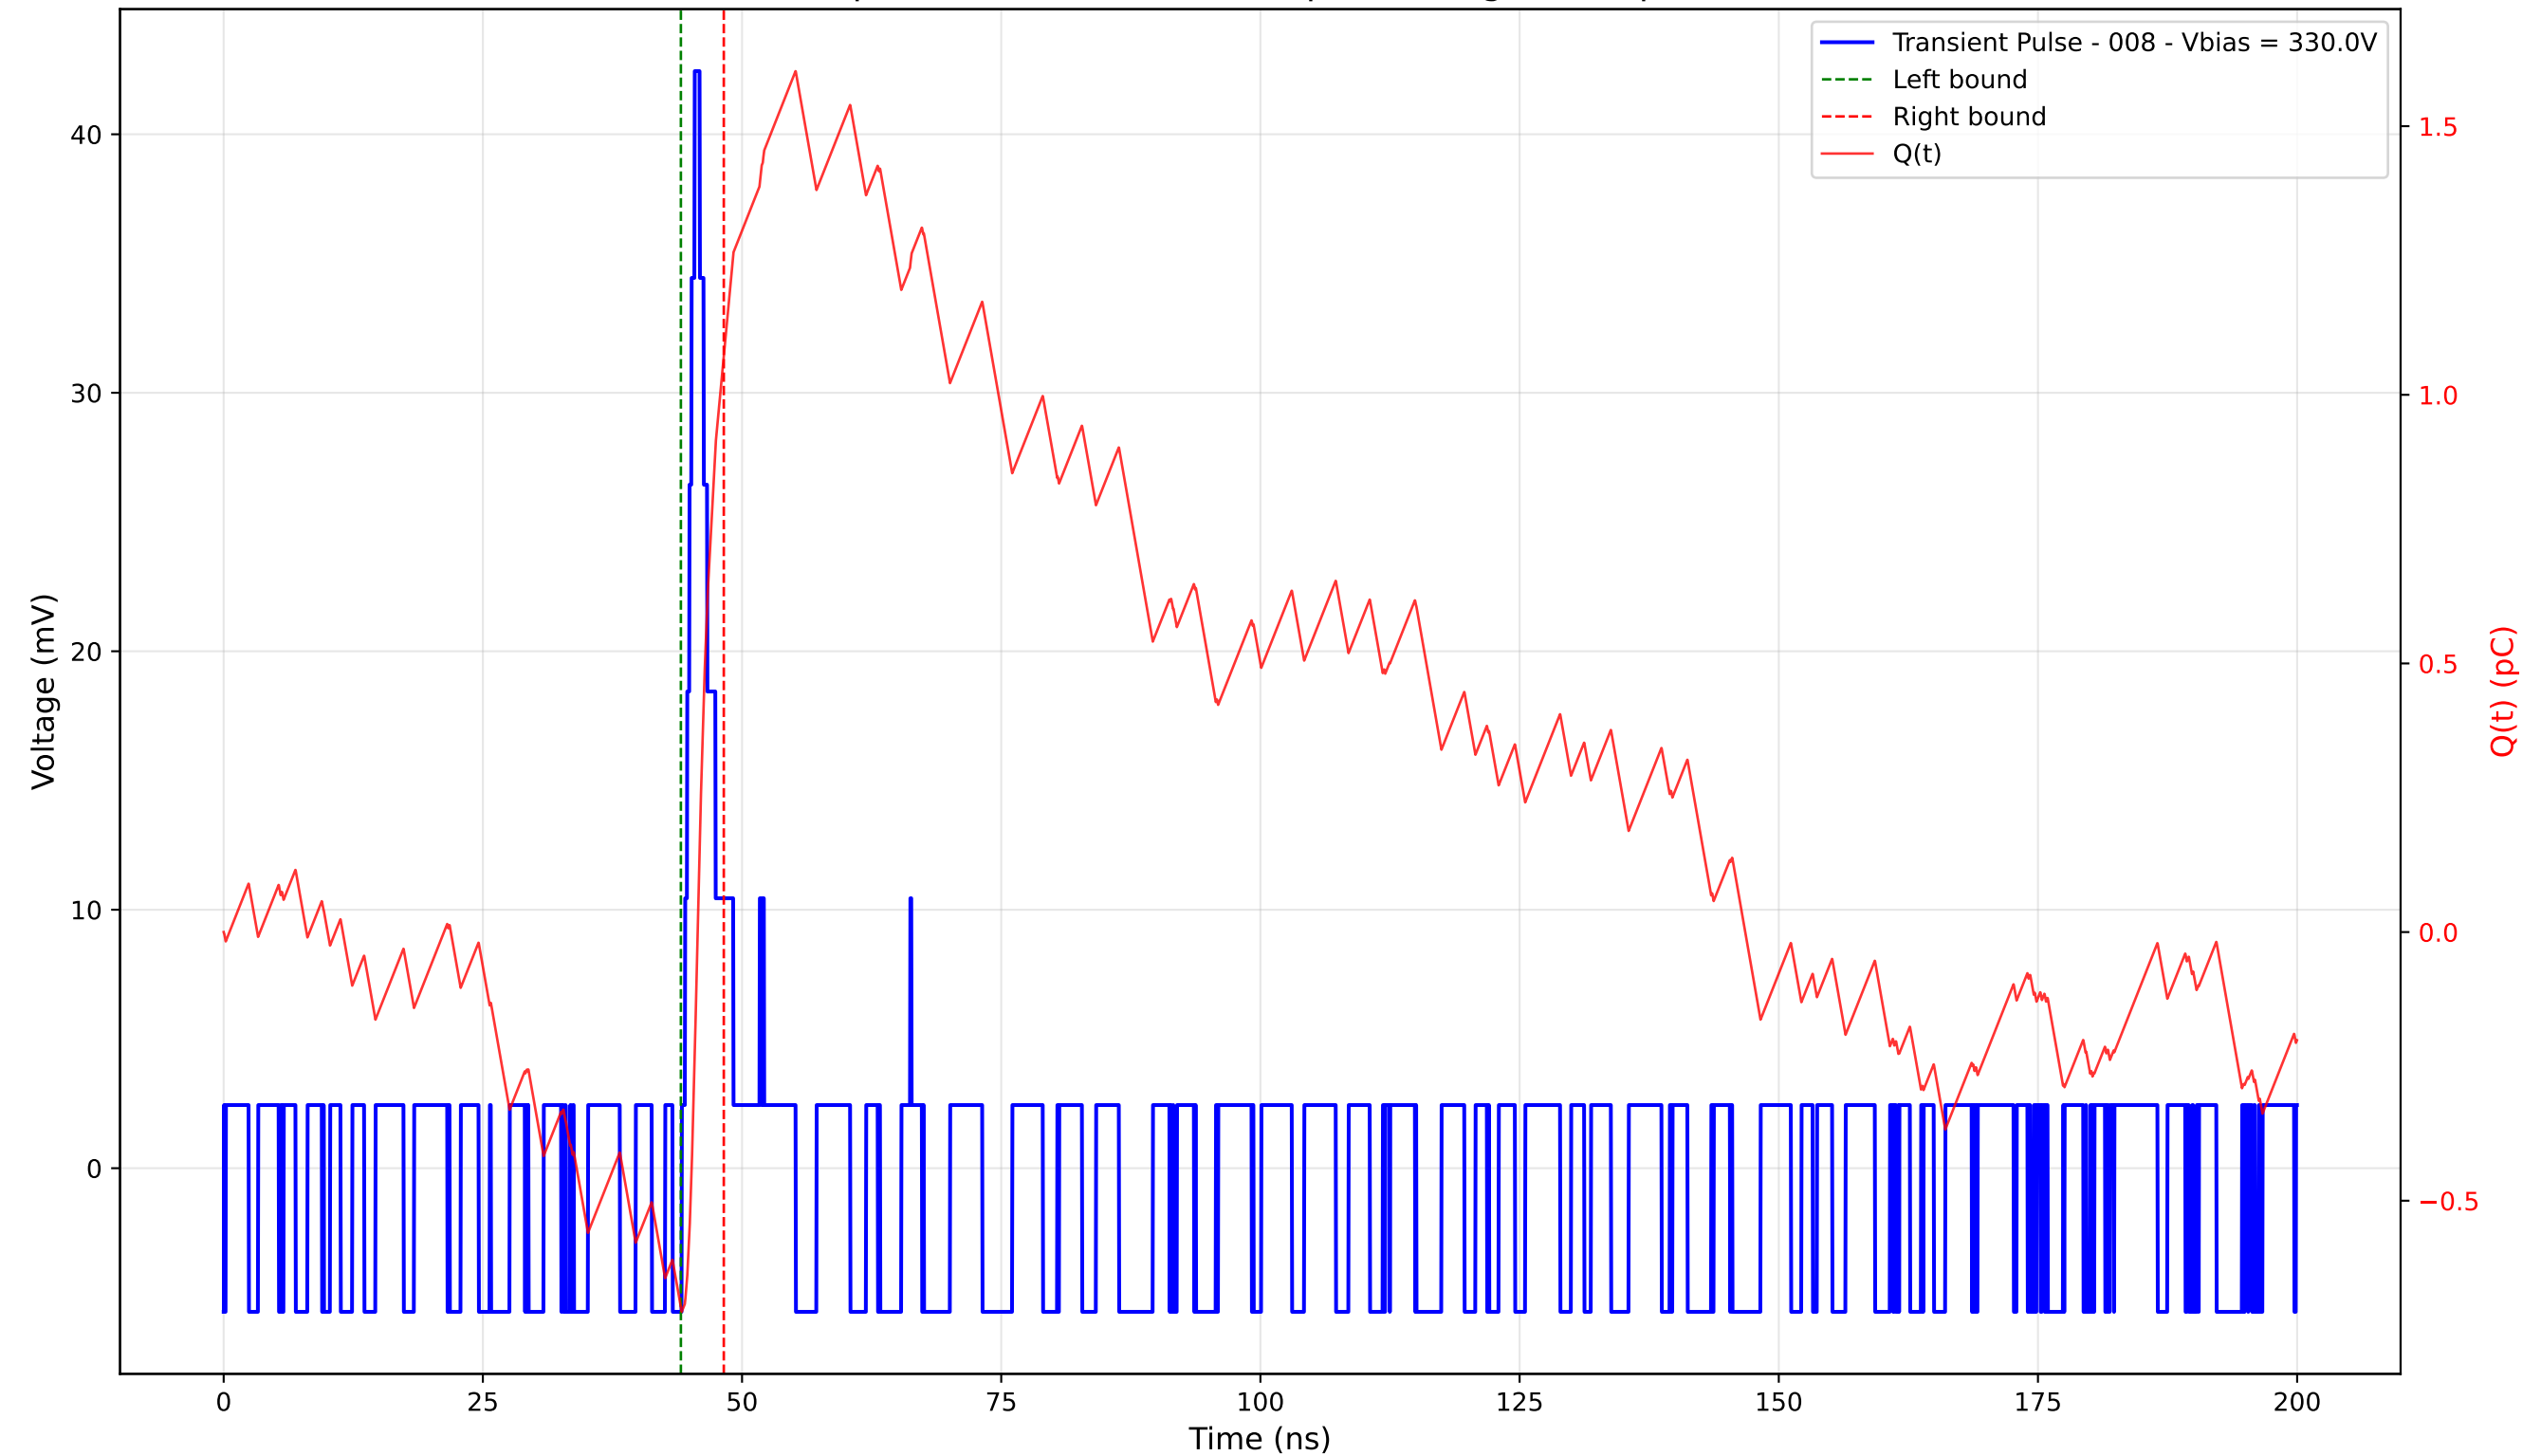


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.67 pC - Rise Time: 1.10 ns

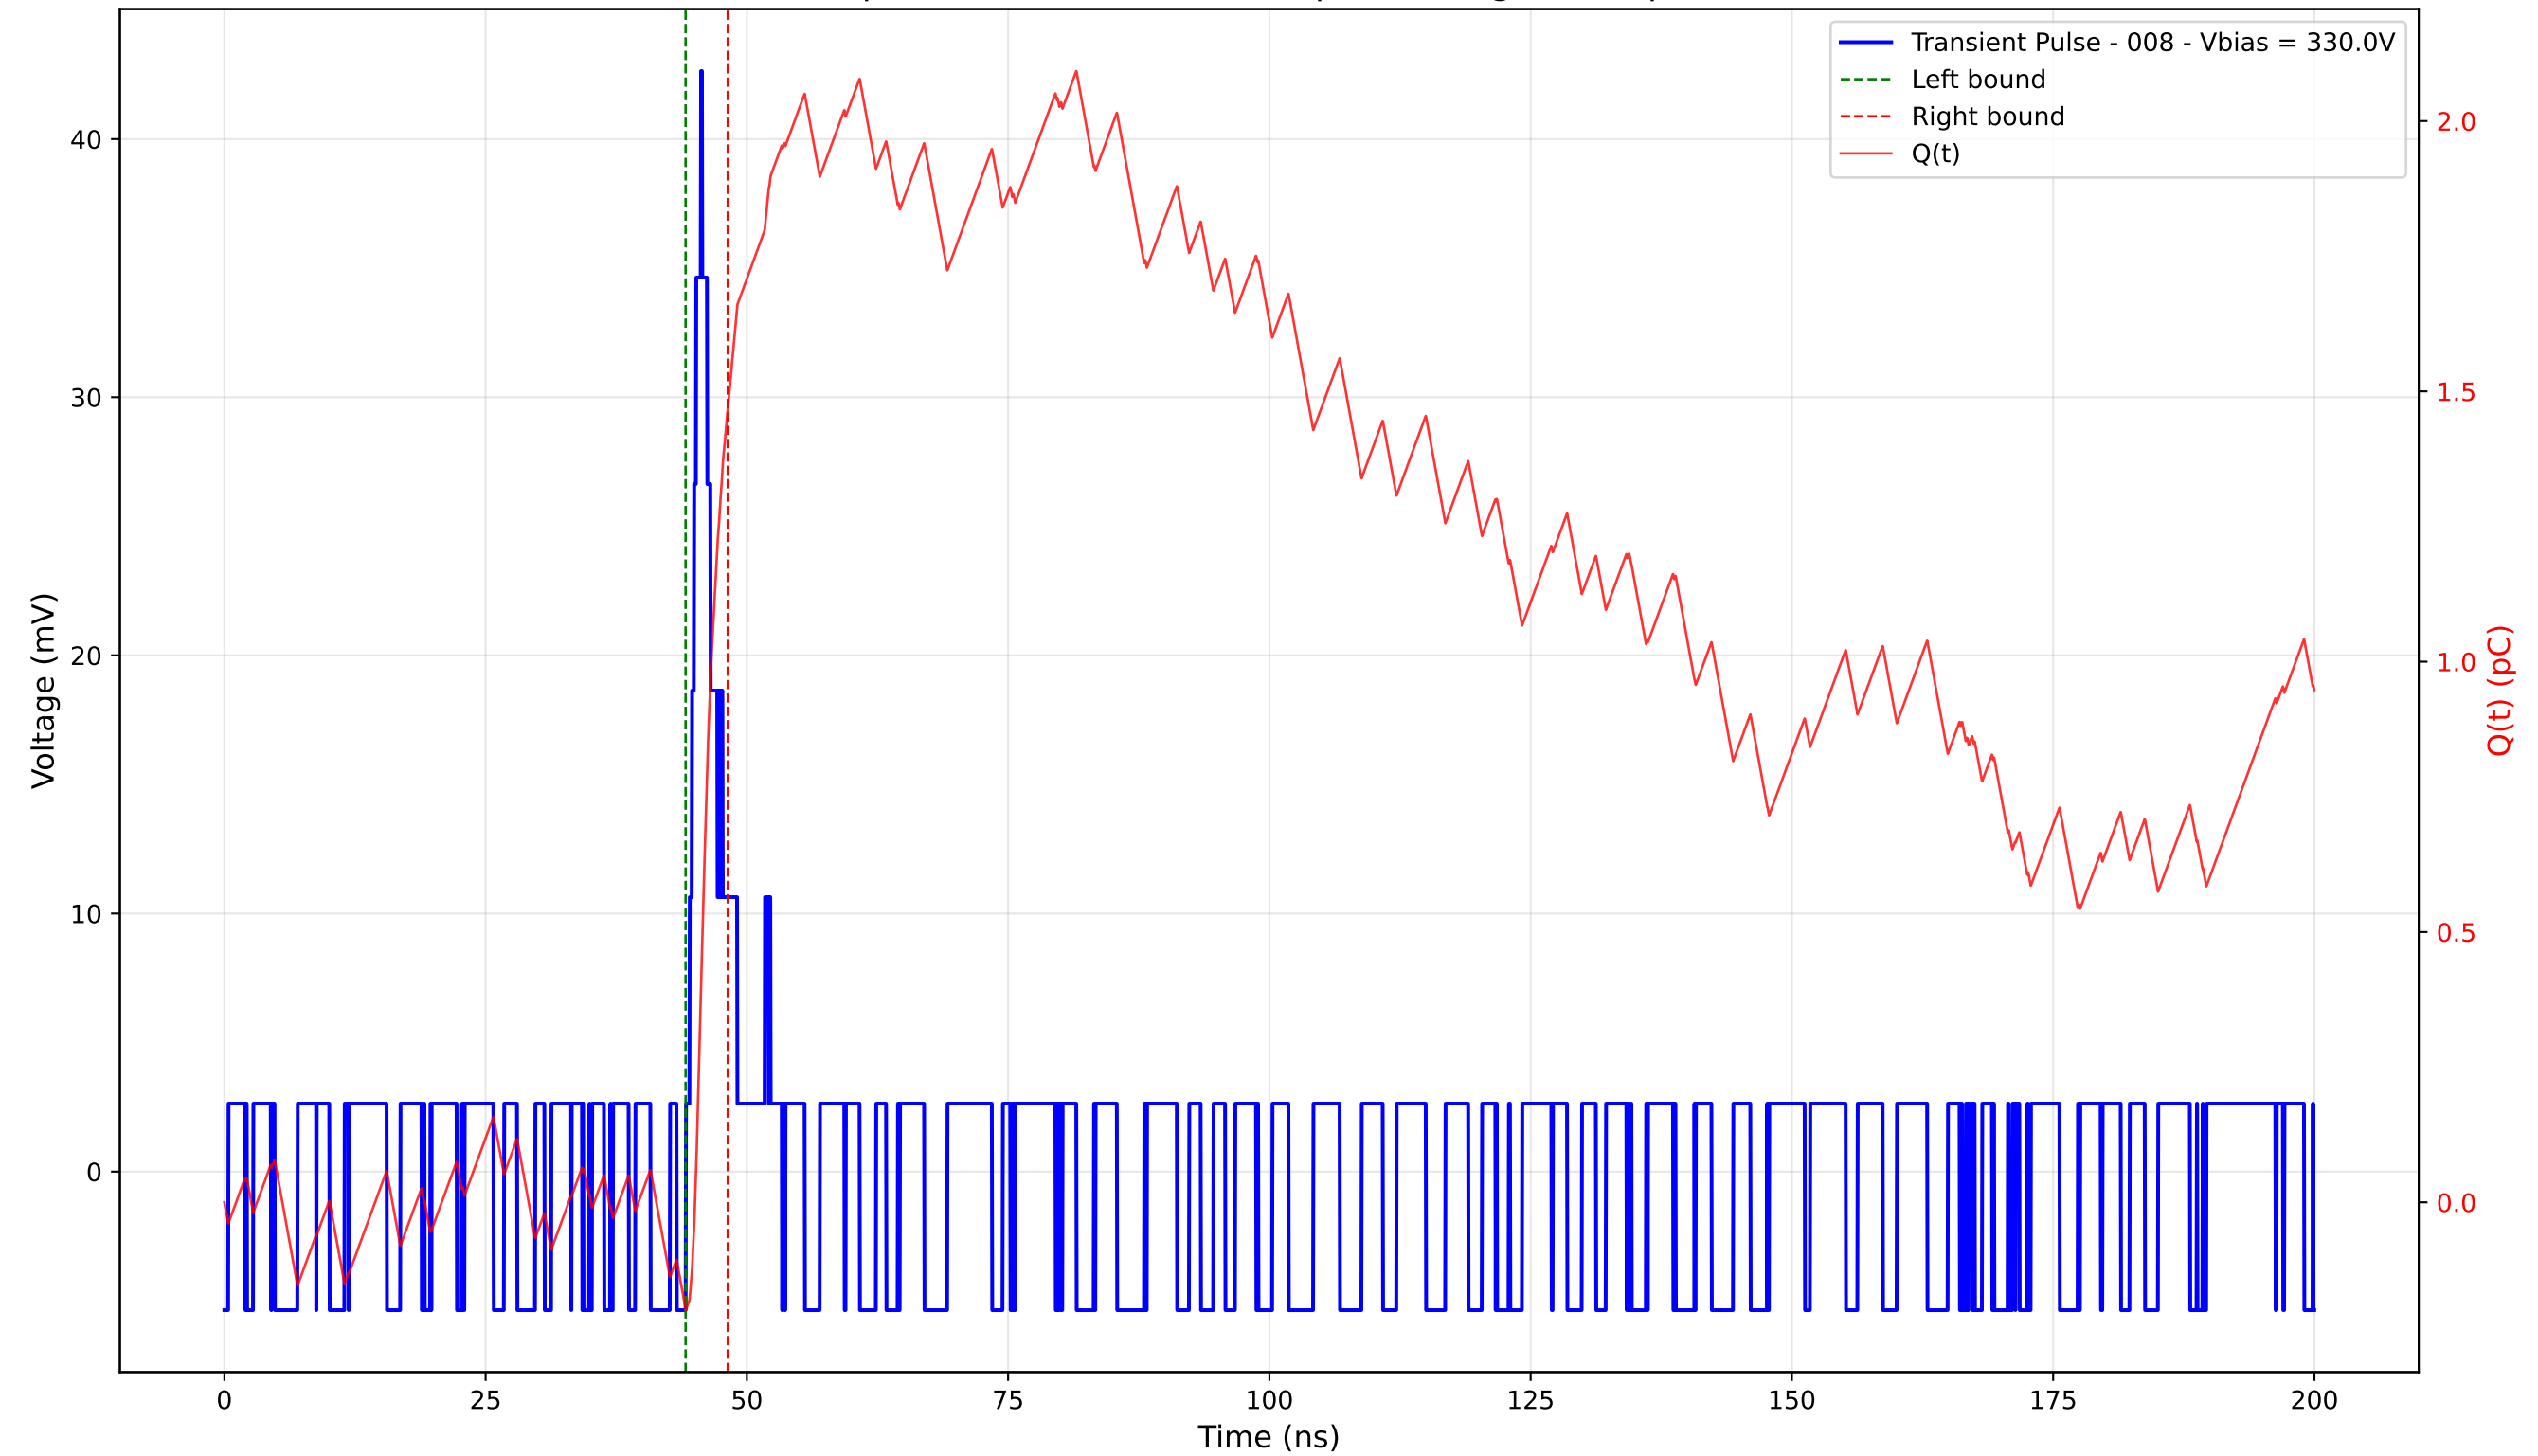


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.57 pC - Rise Time: 0.80 ns

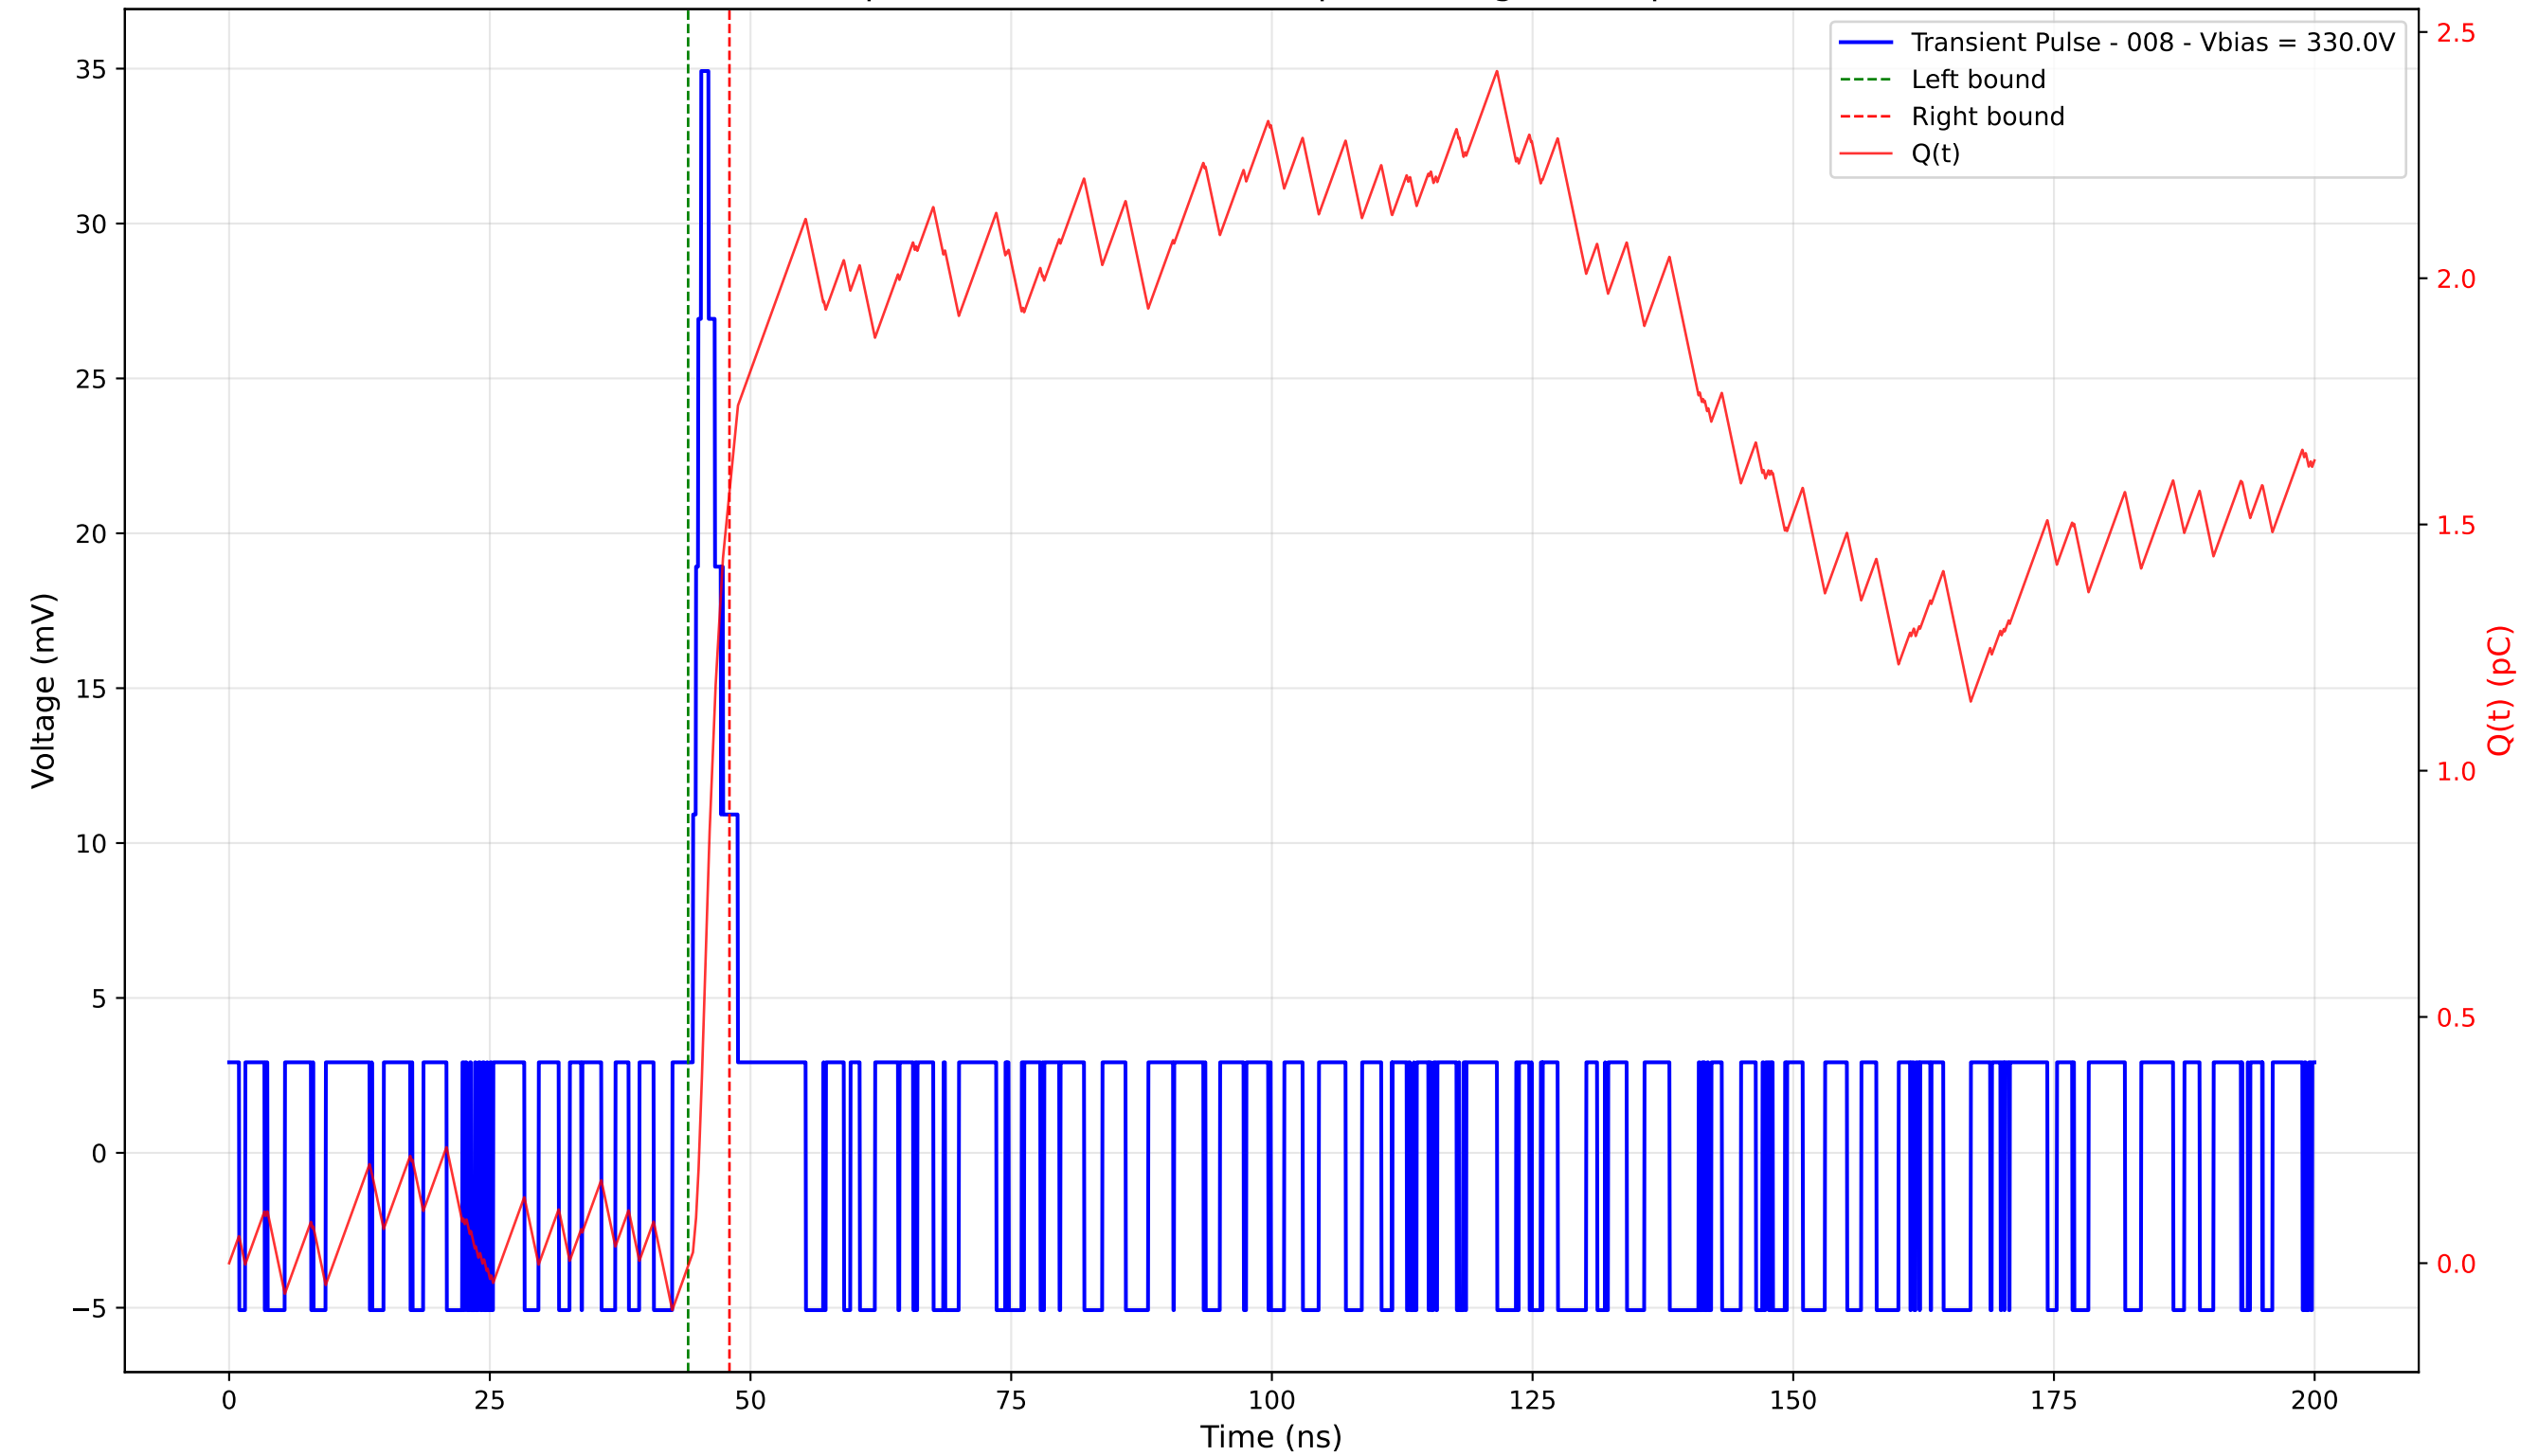


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.43 pC - Rise Time: 1.05 ns

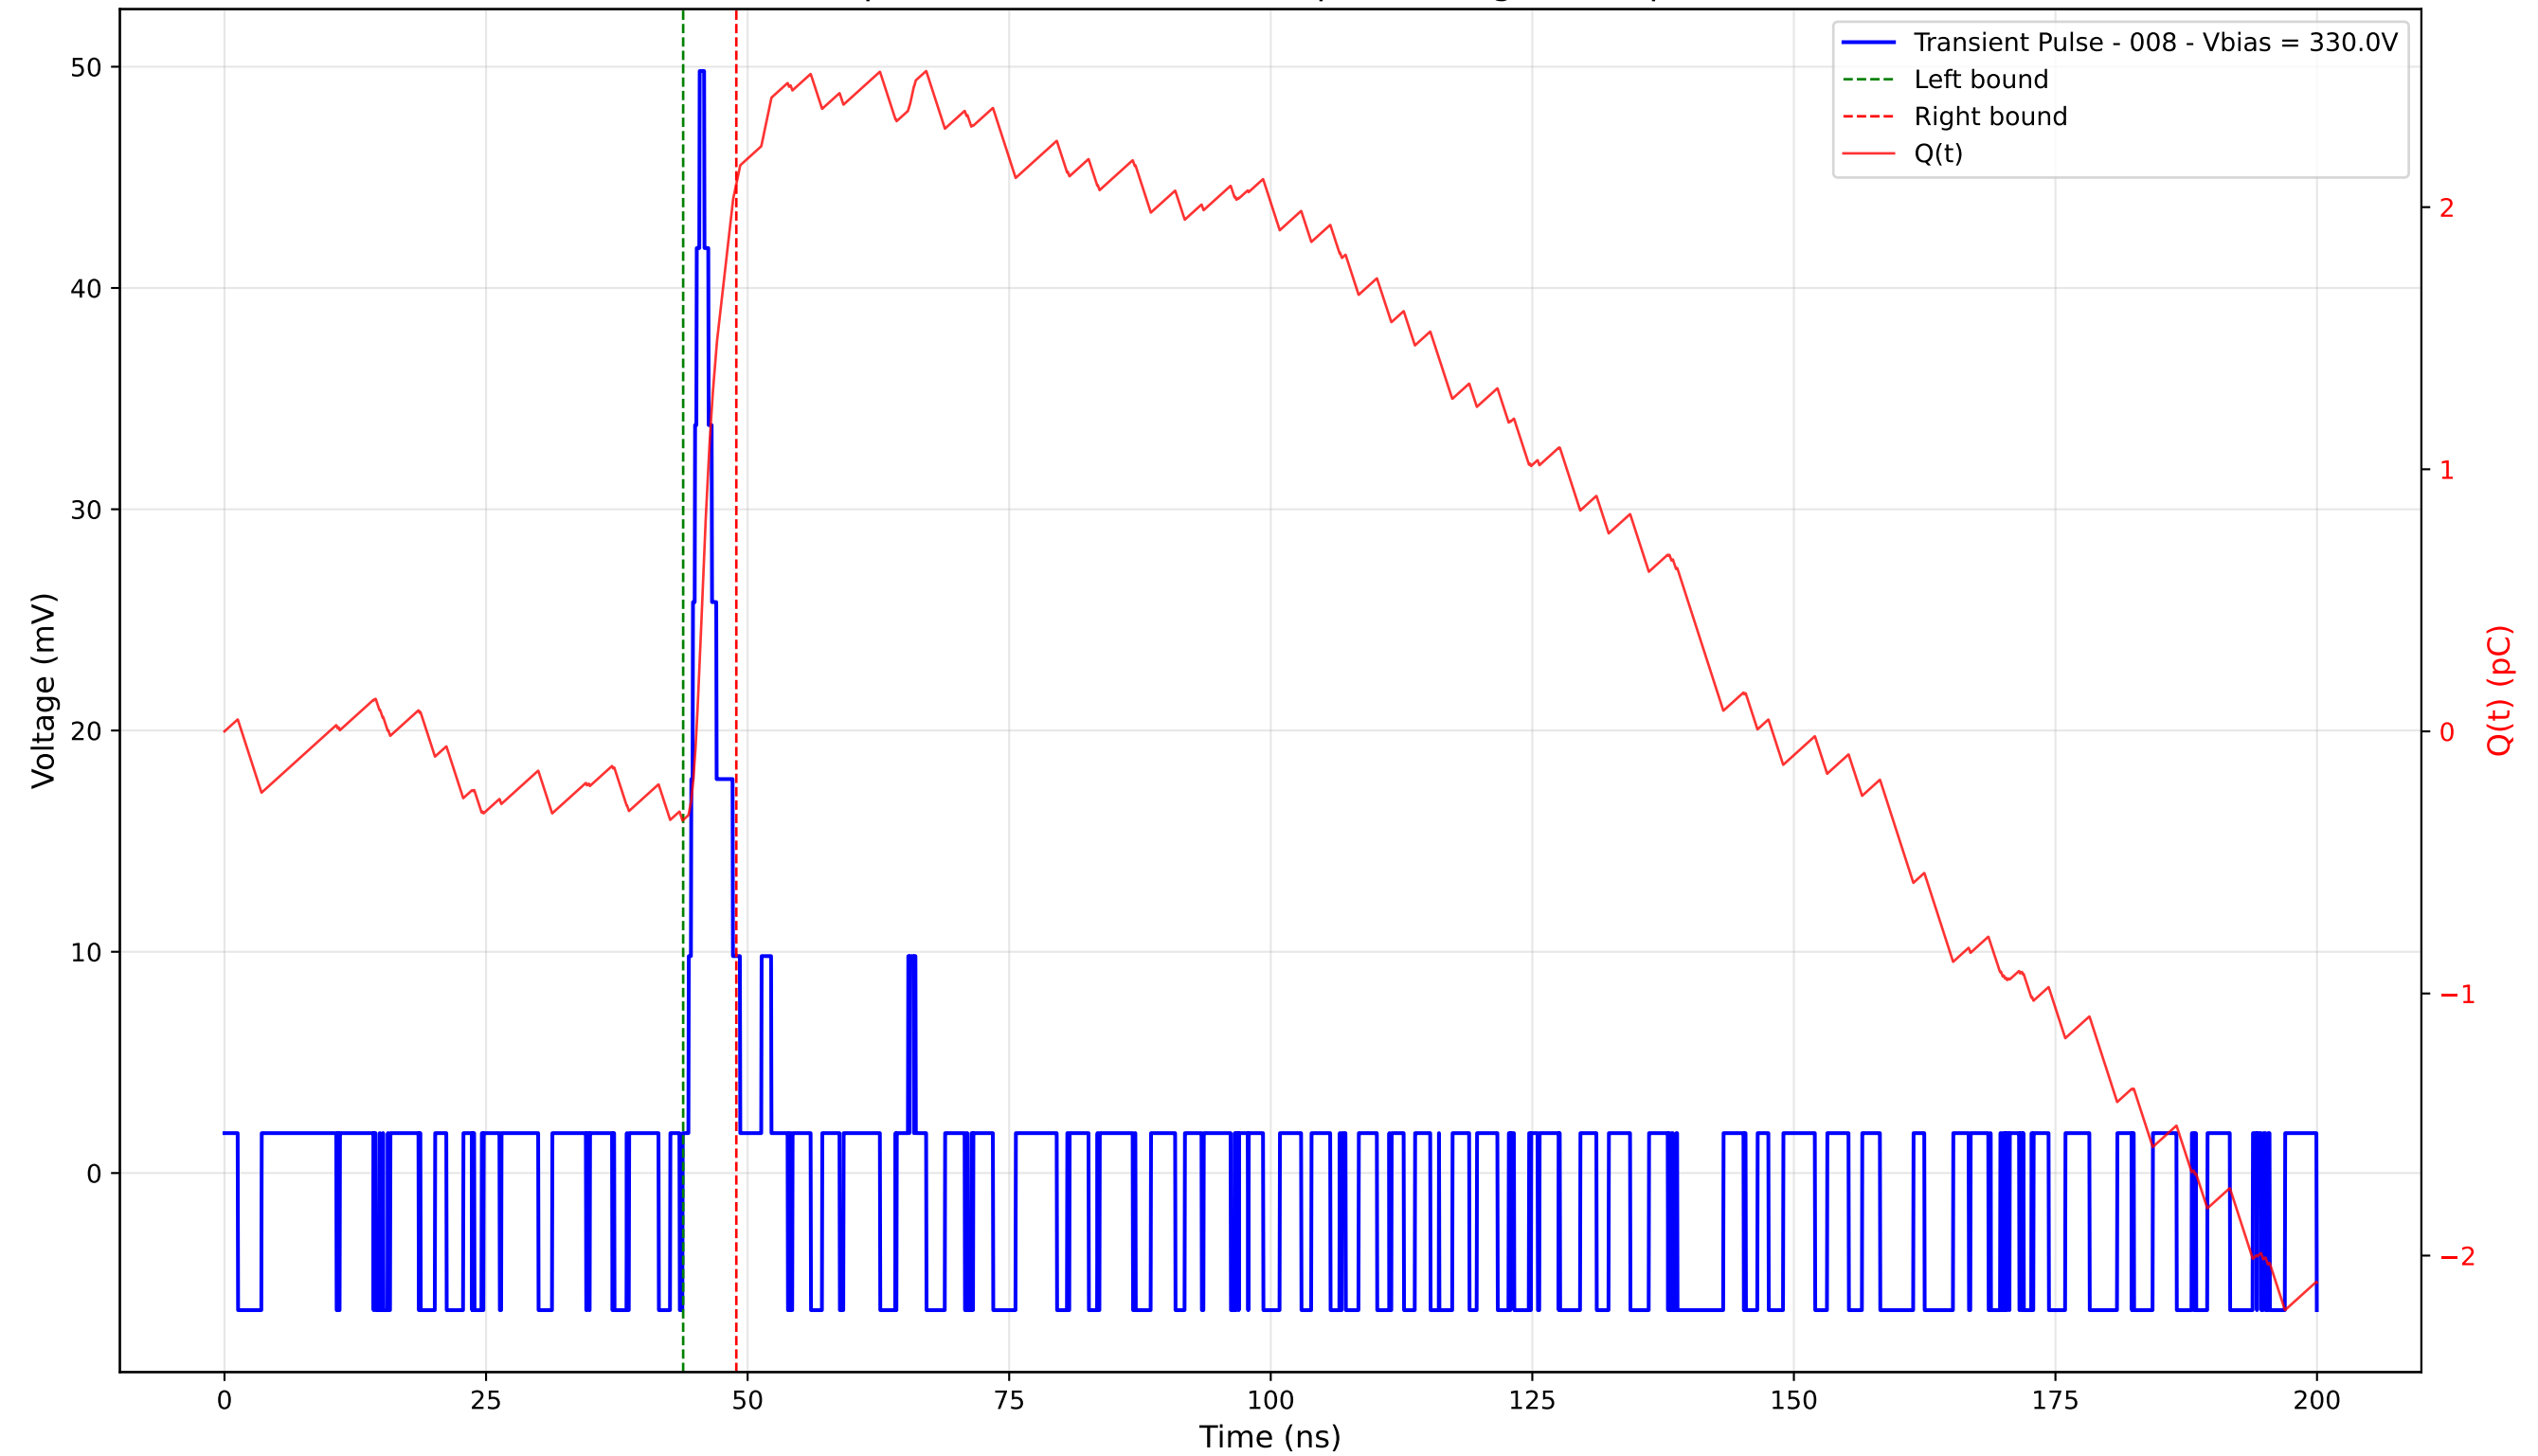


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 3.17 pC - Rise Time: 1.23 ns

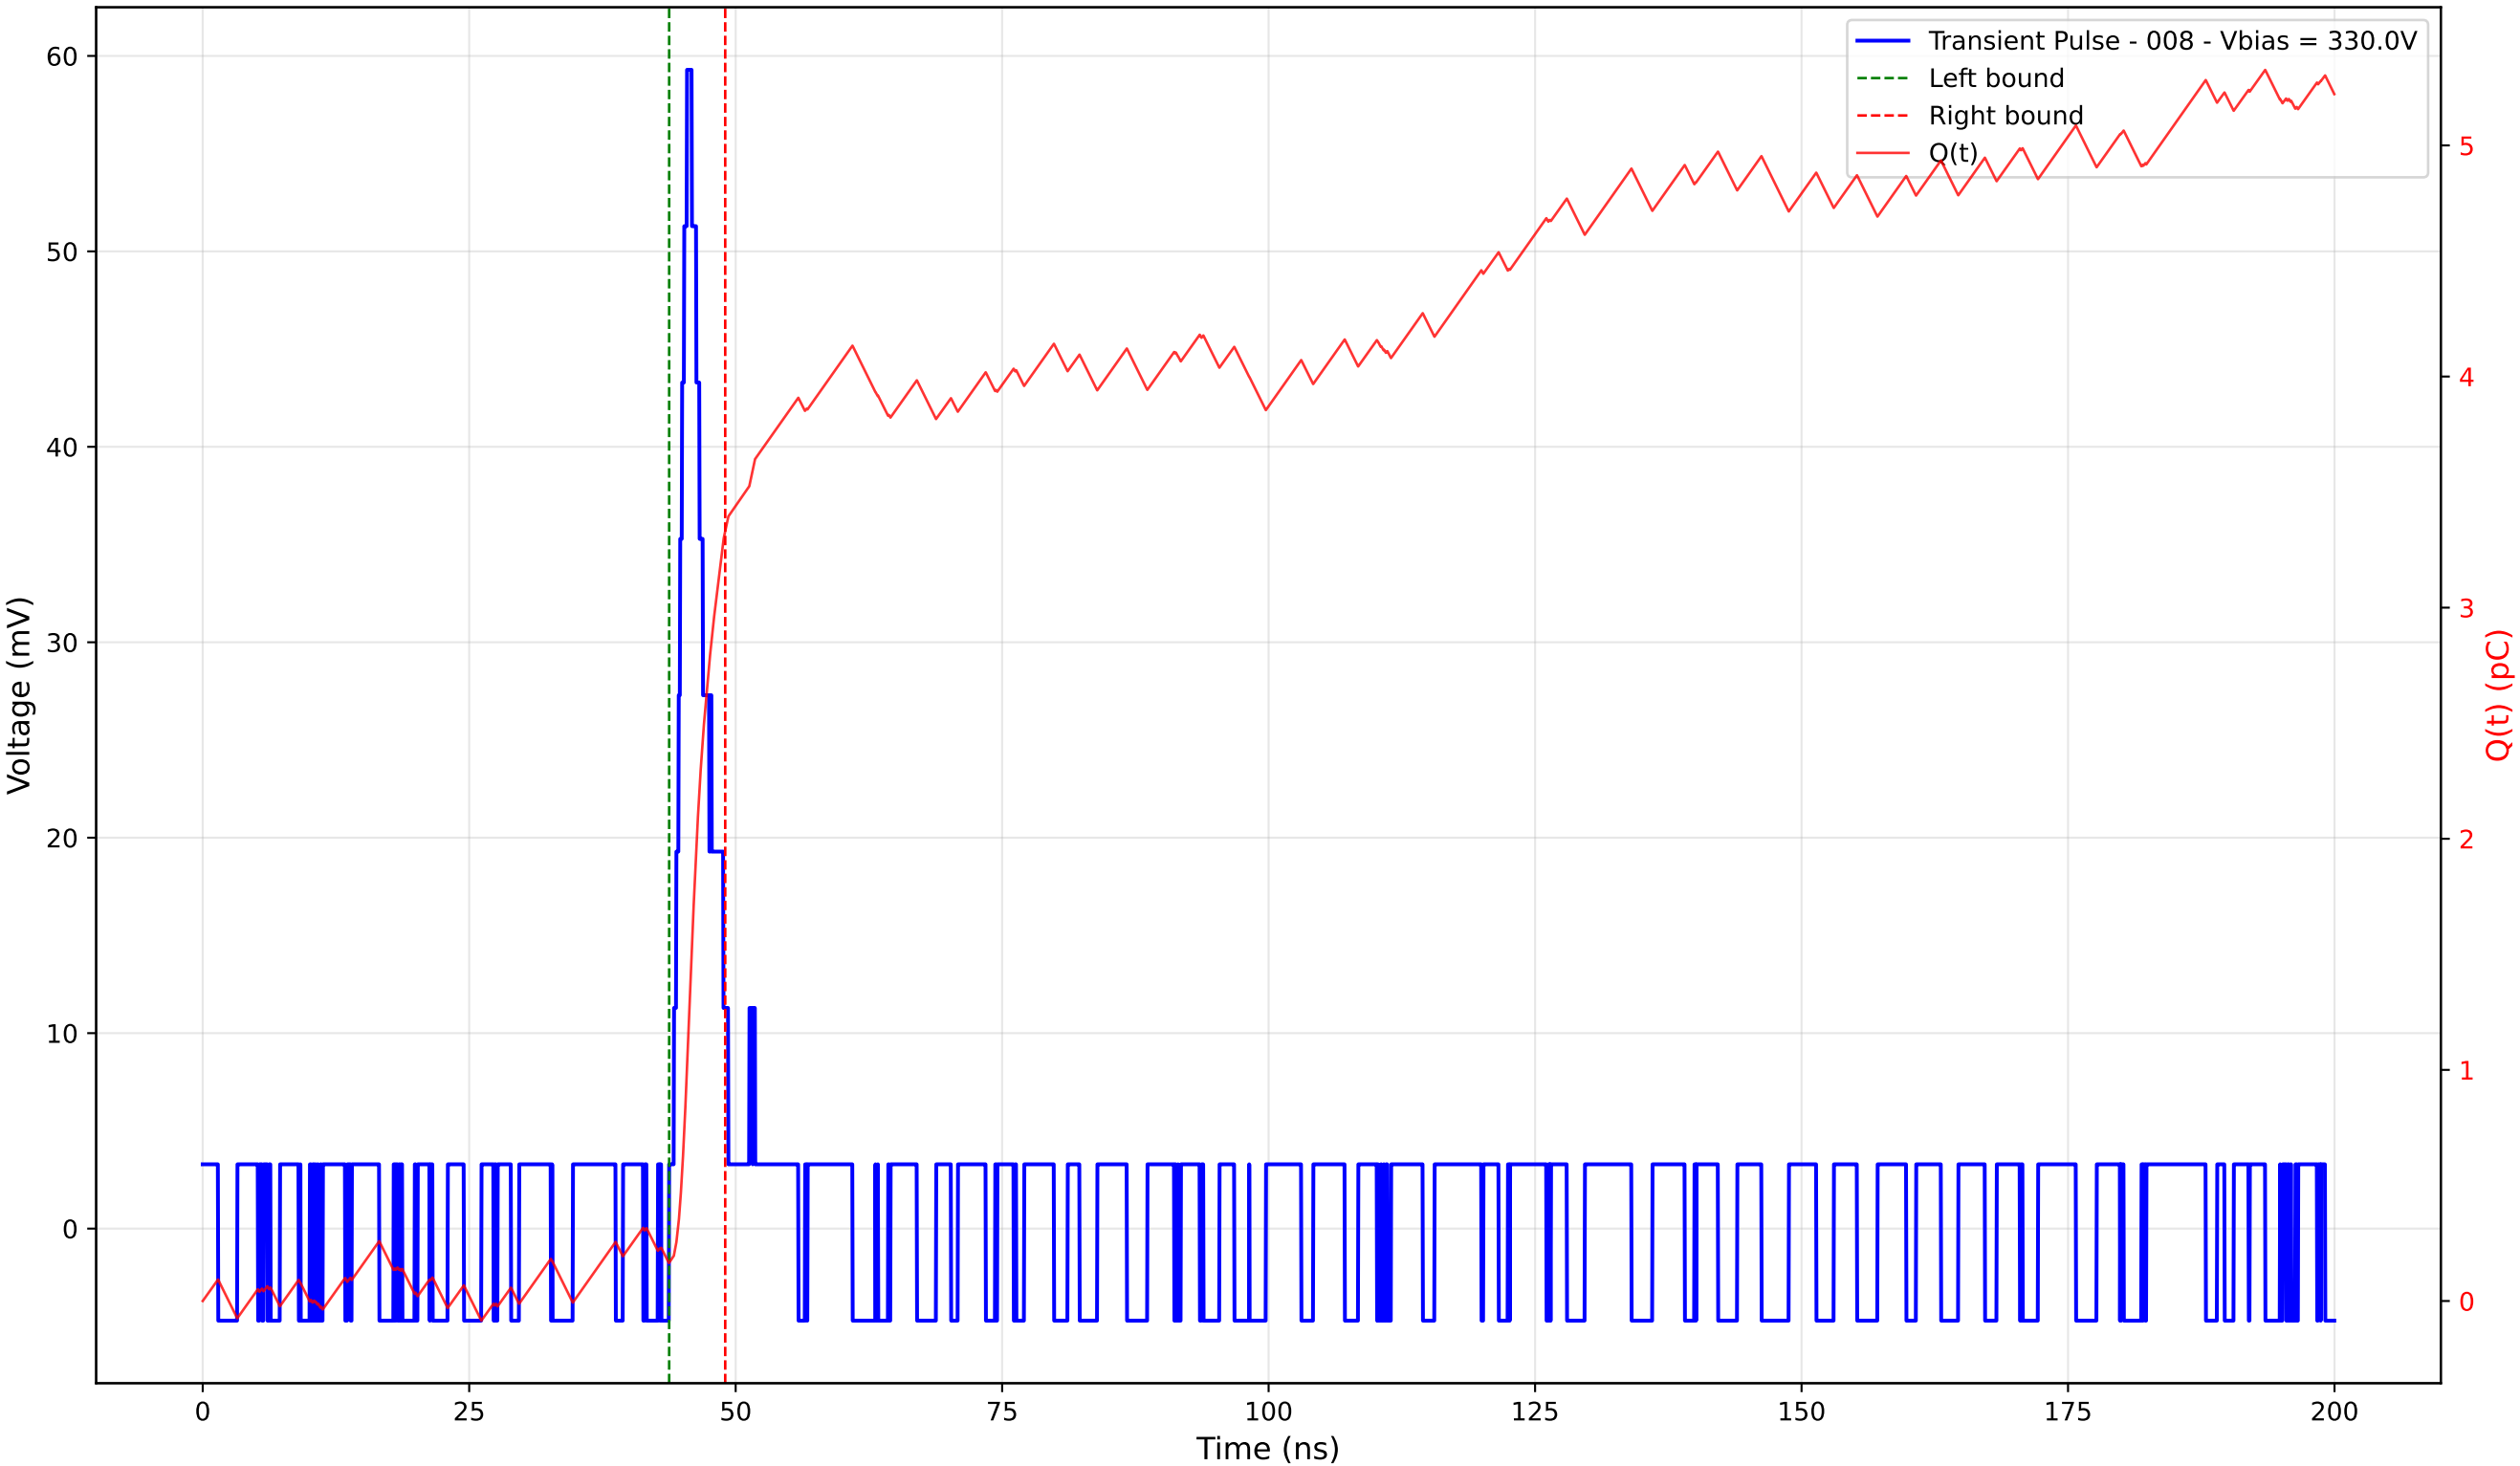


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.61 pC - Rise Time: 1.09 ns

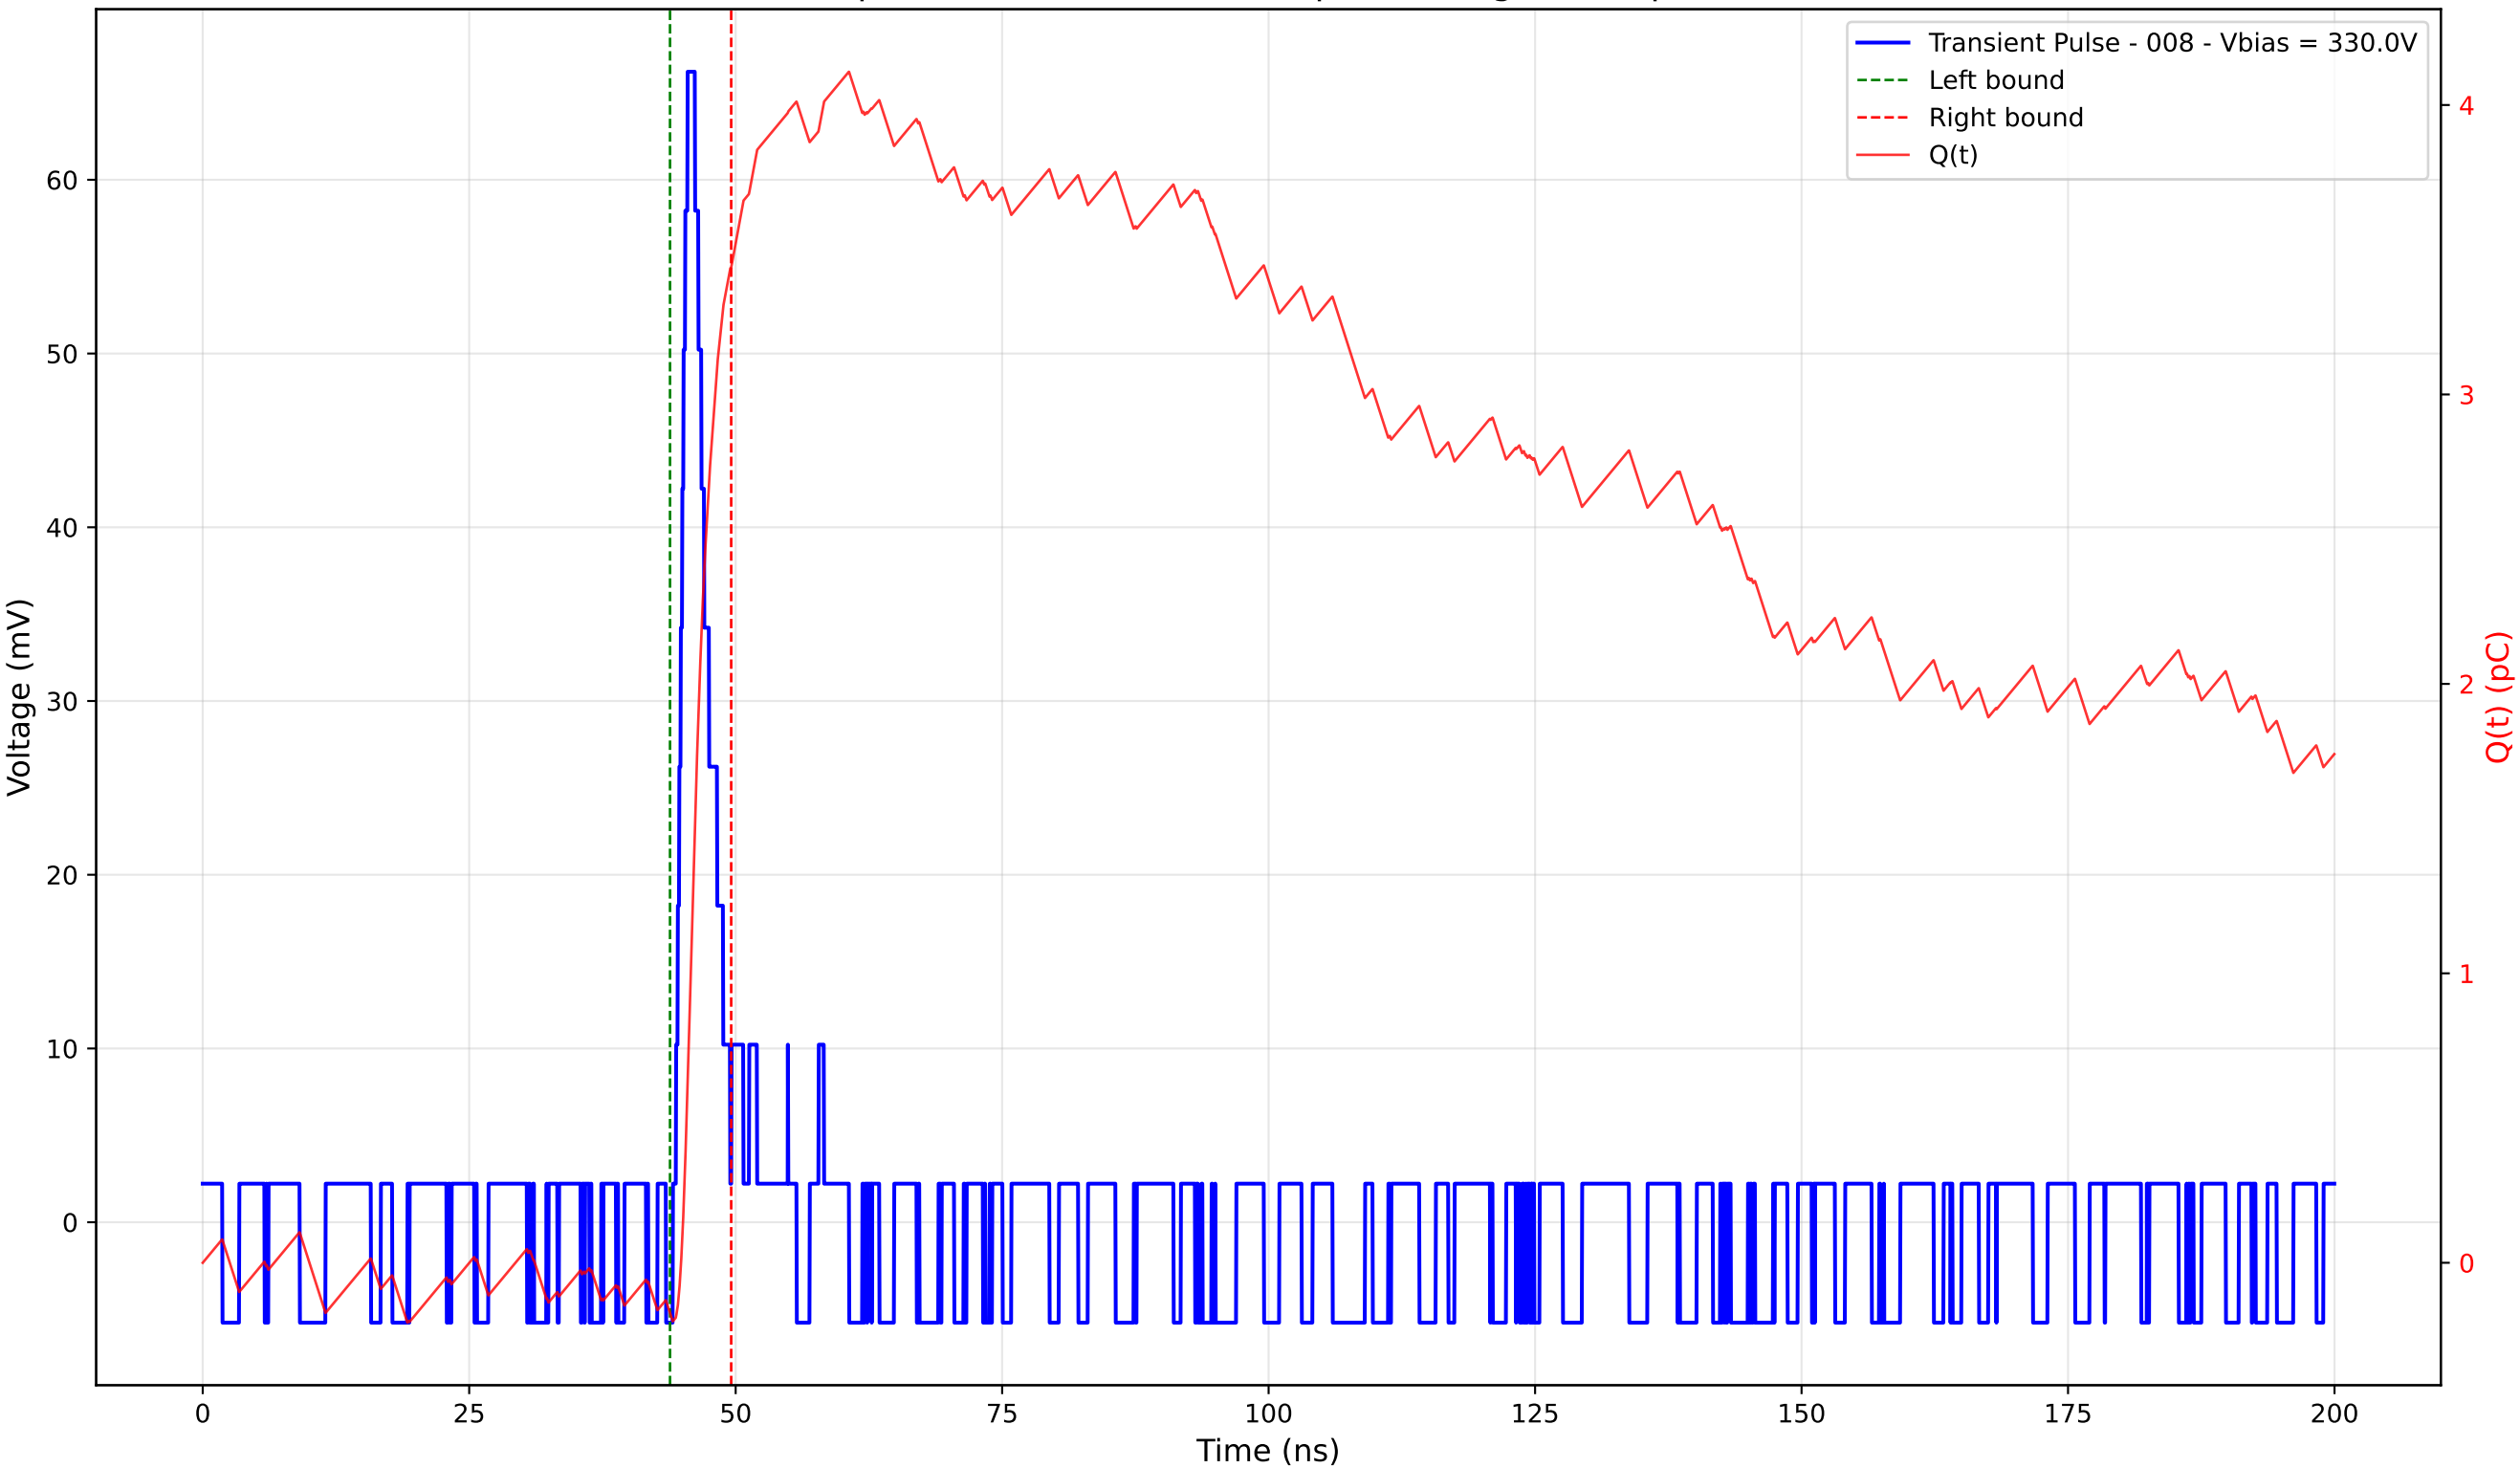


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.22 pC - Rise Time: 0.93 ns

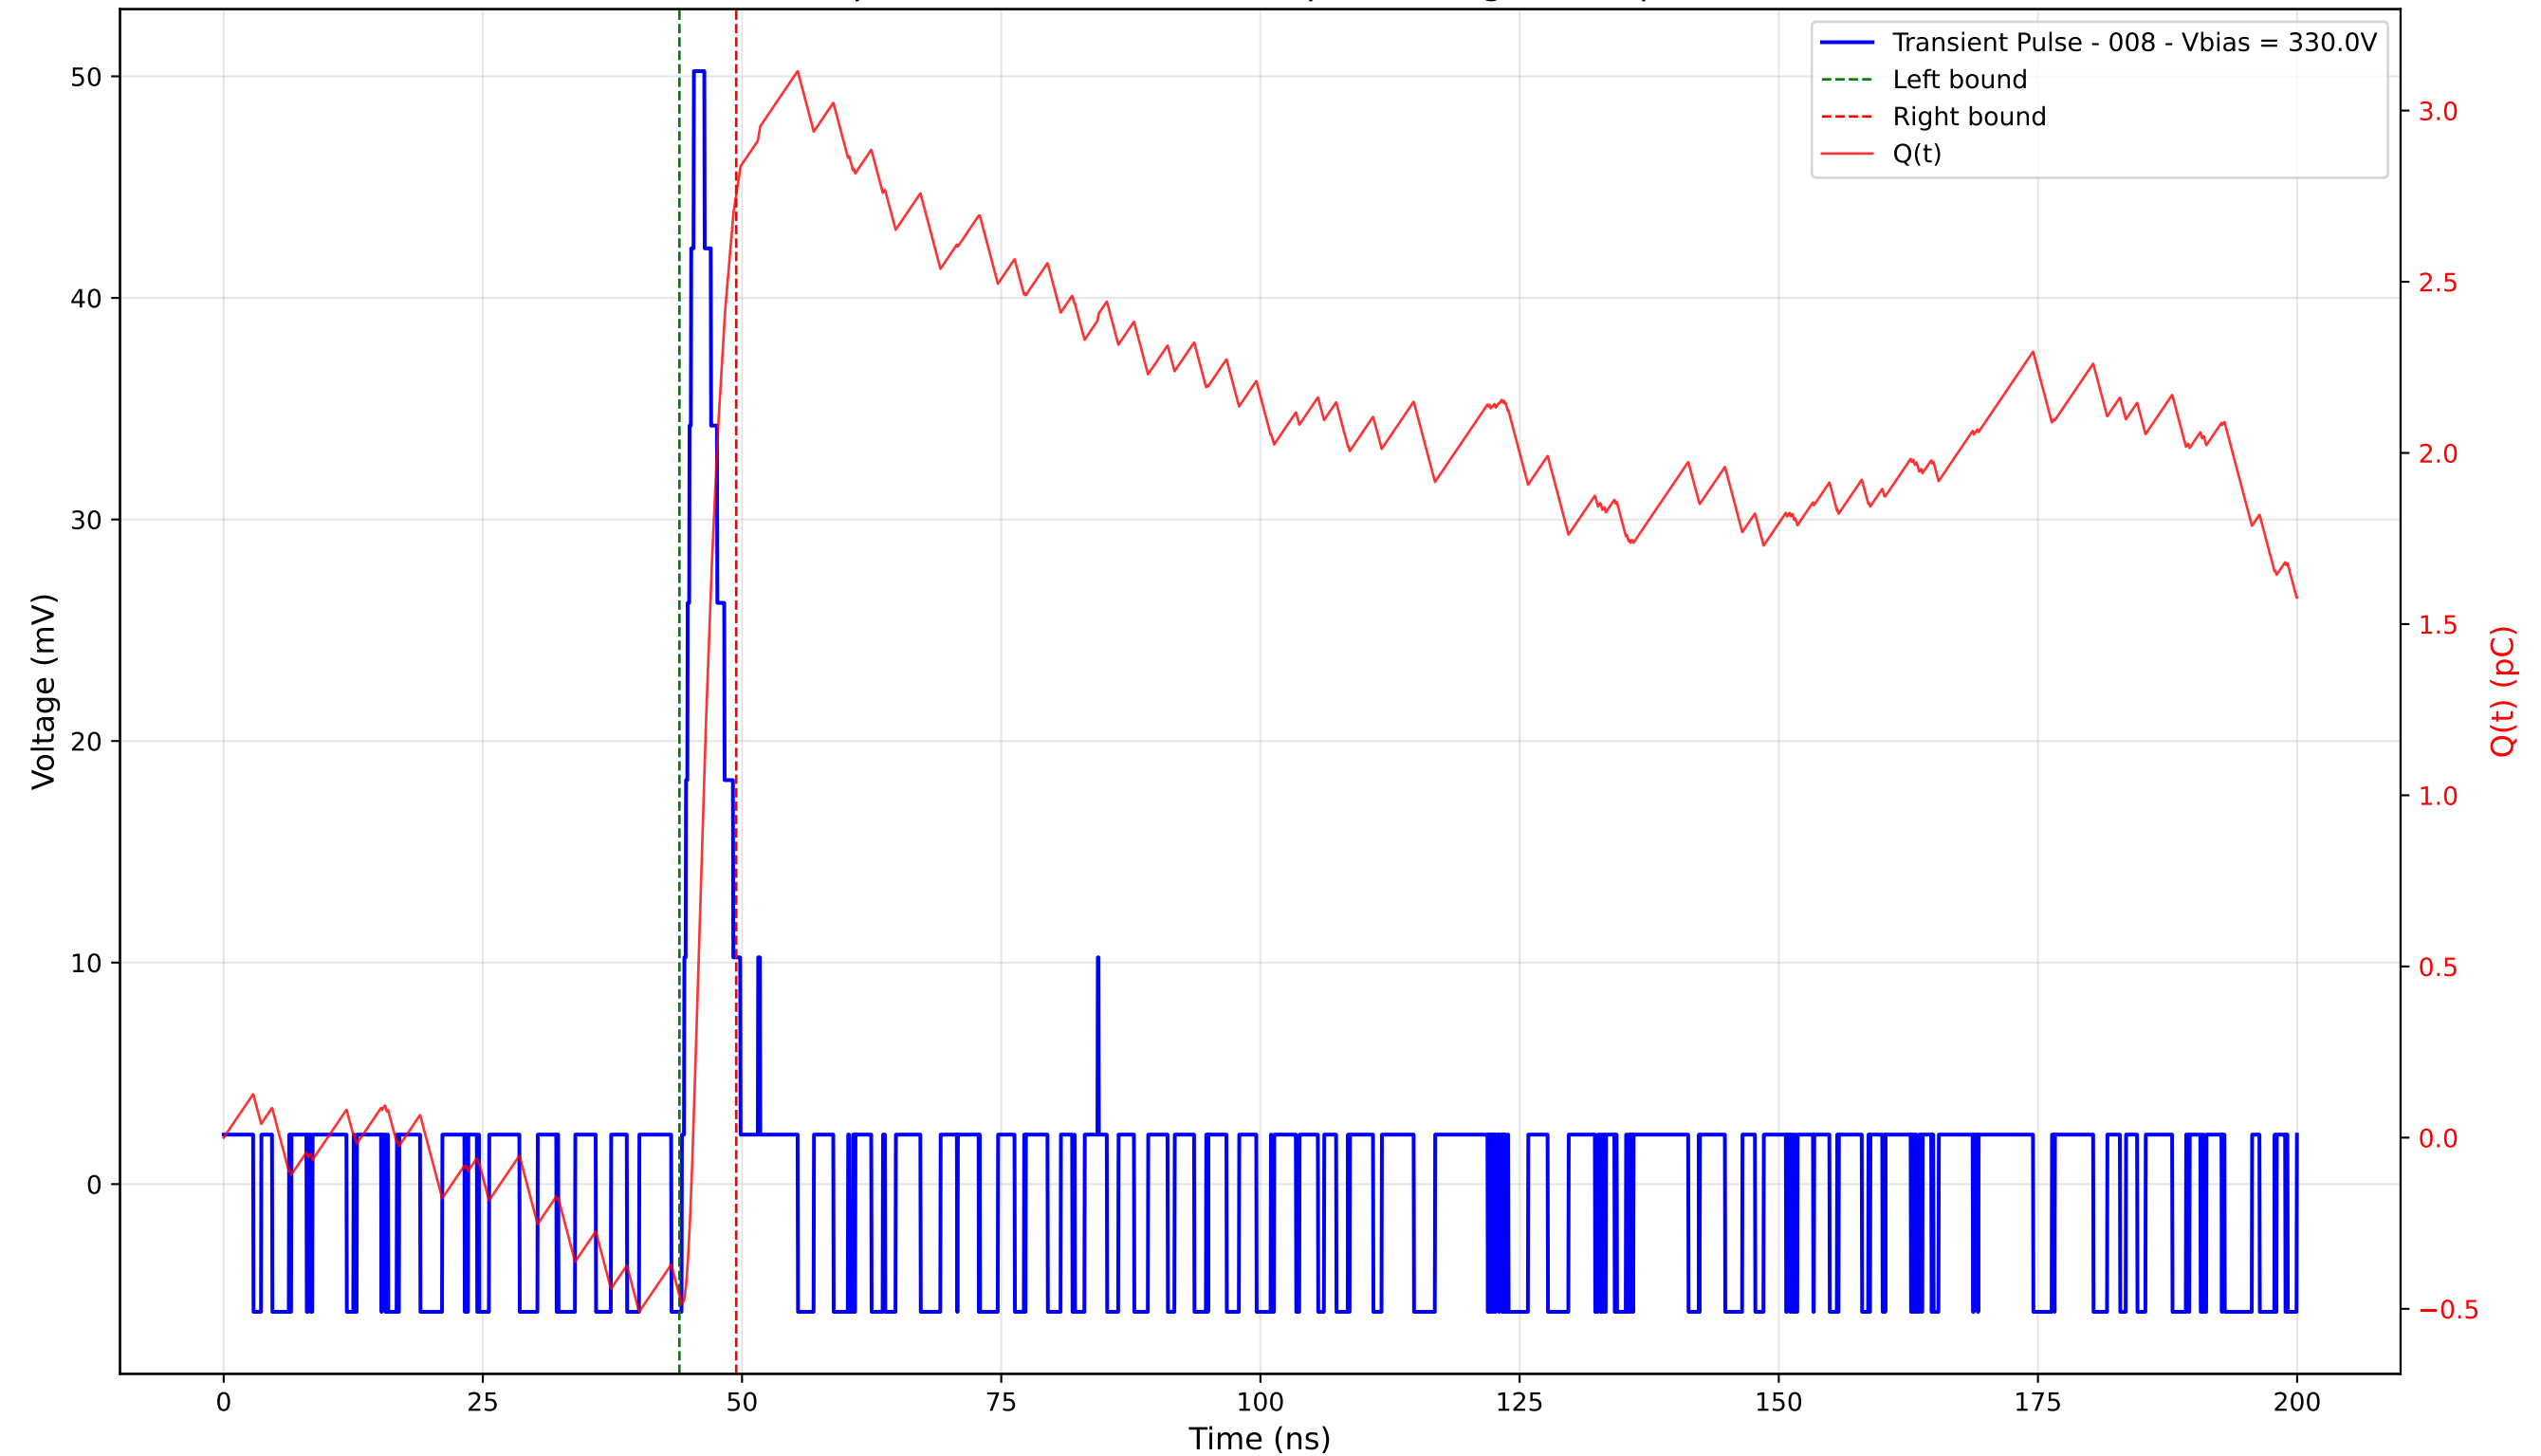


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 2.00 pC - Rise Time: 0.96 ns

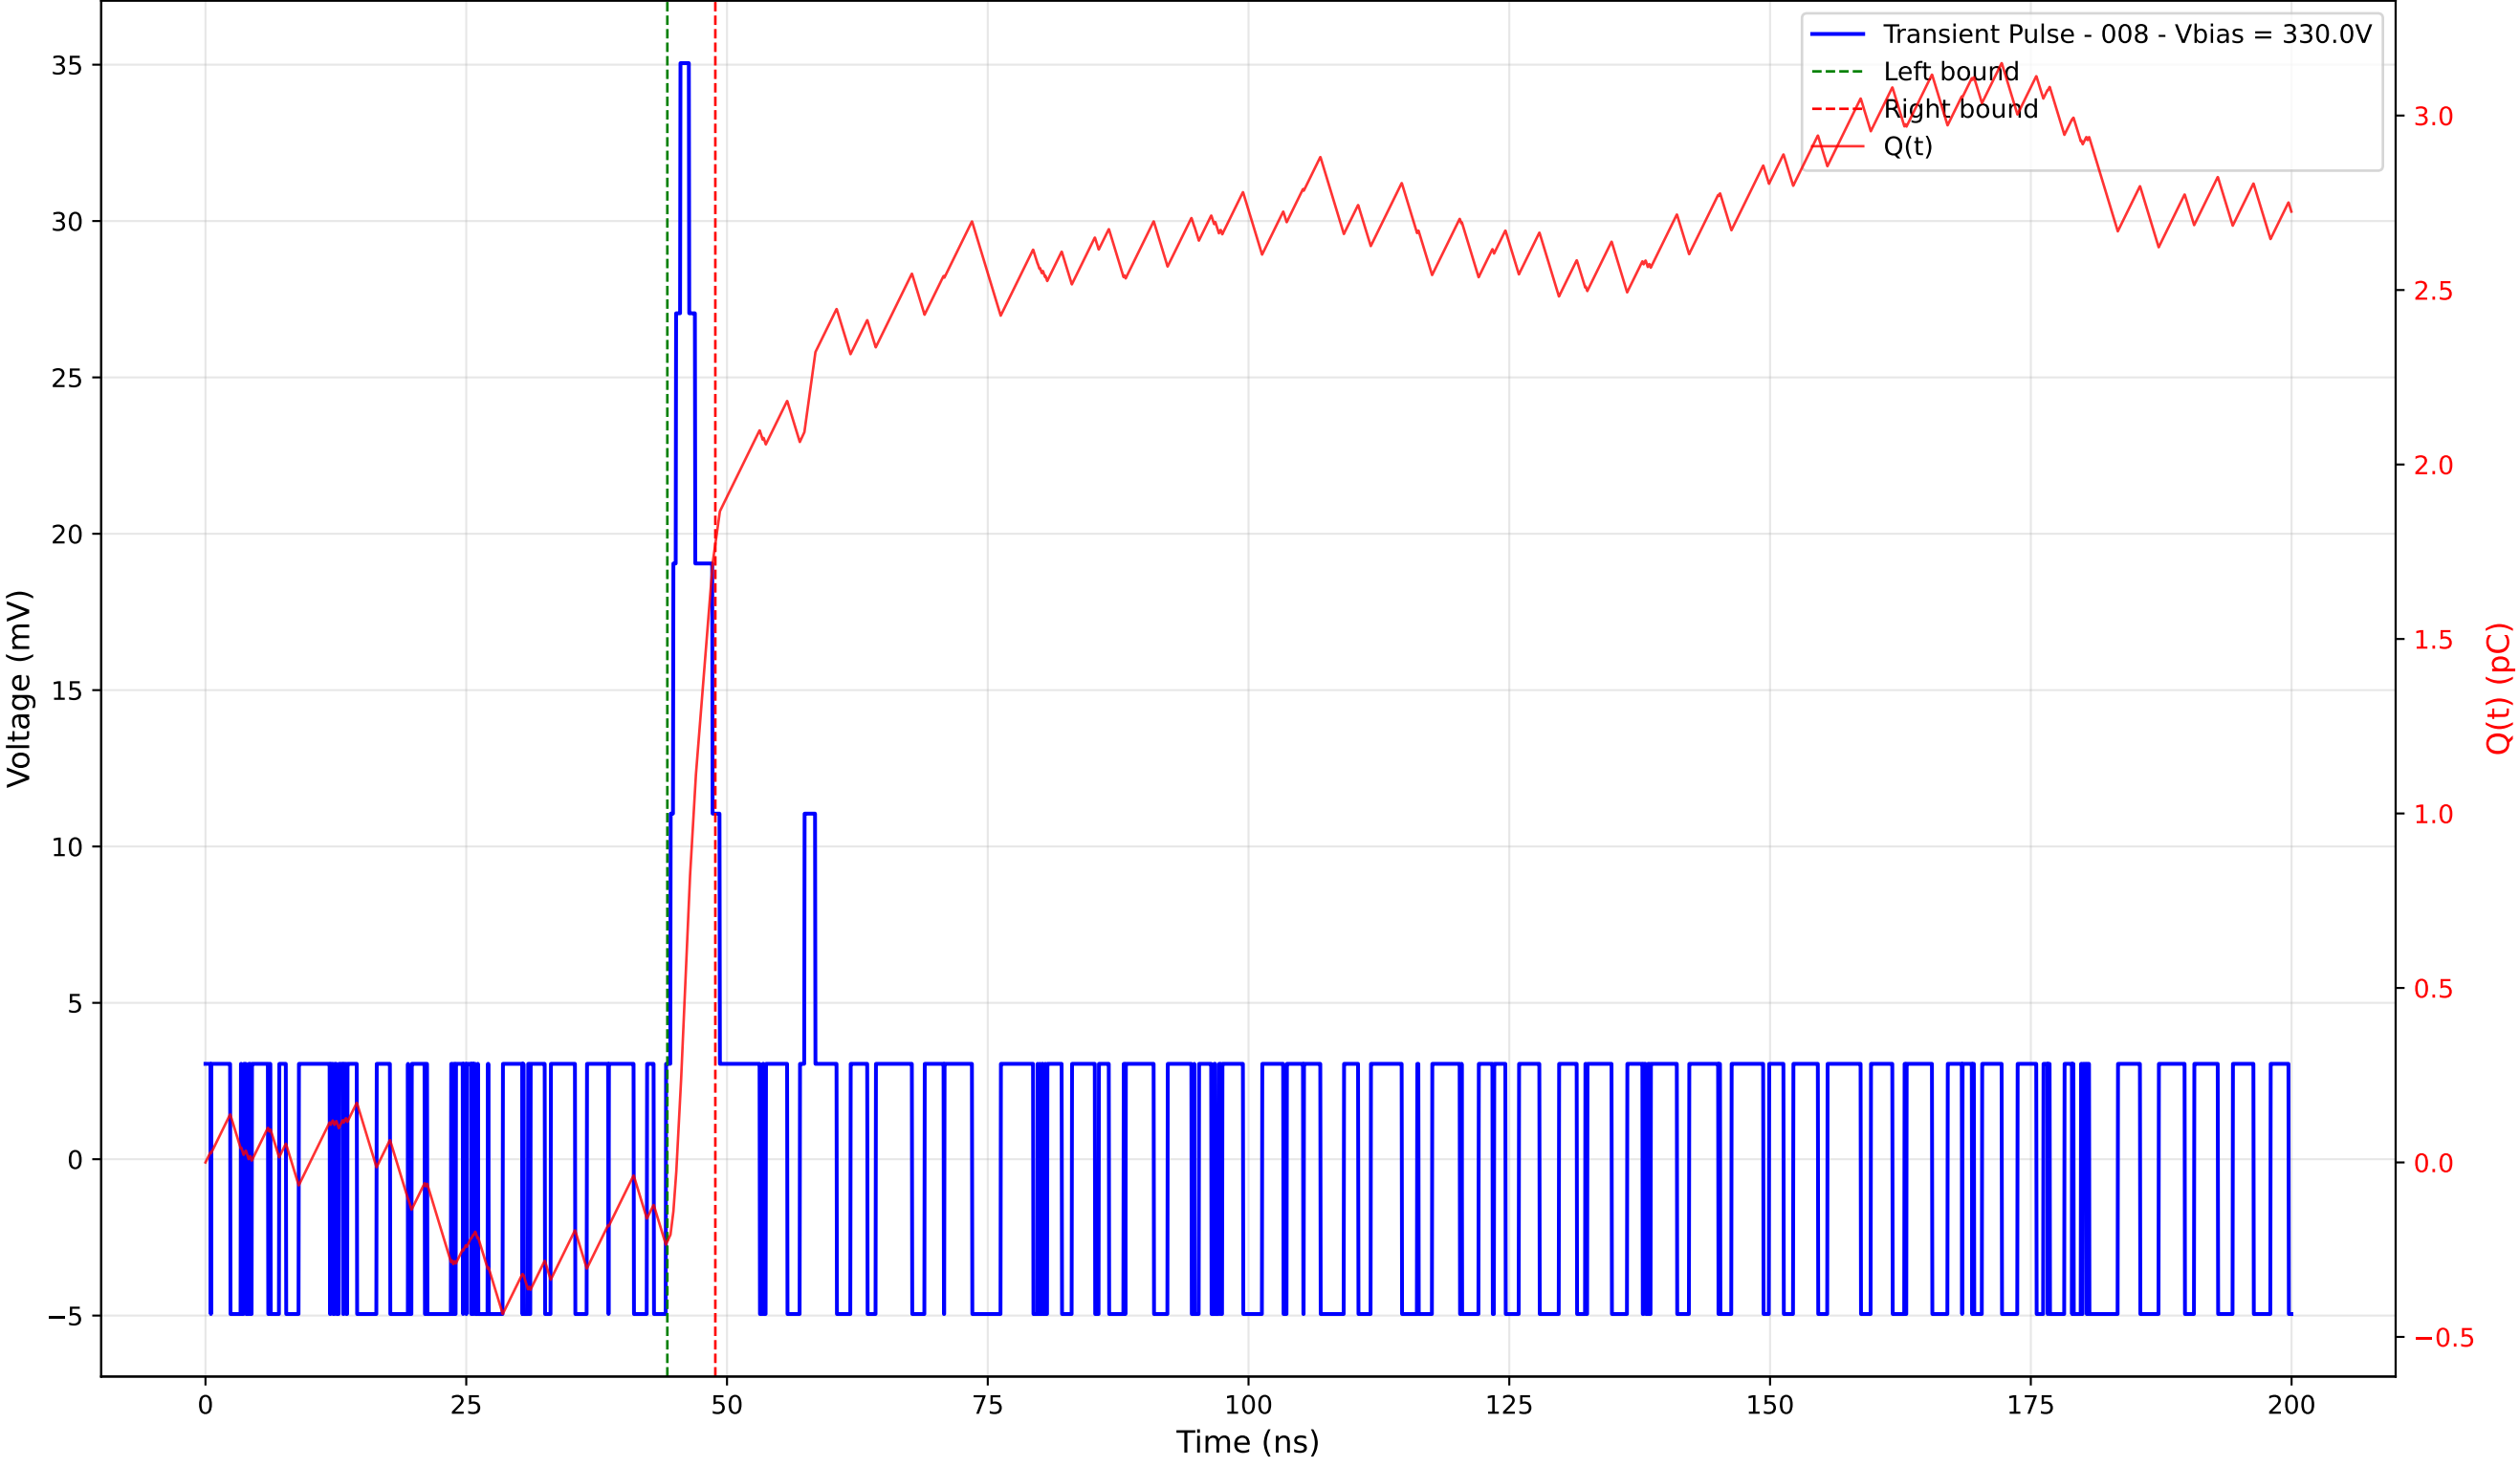


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 1.72 pC - Rise Time: 0.00 ns (N/A)

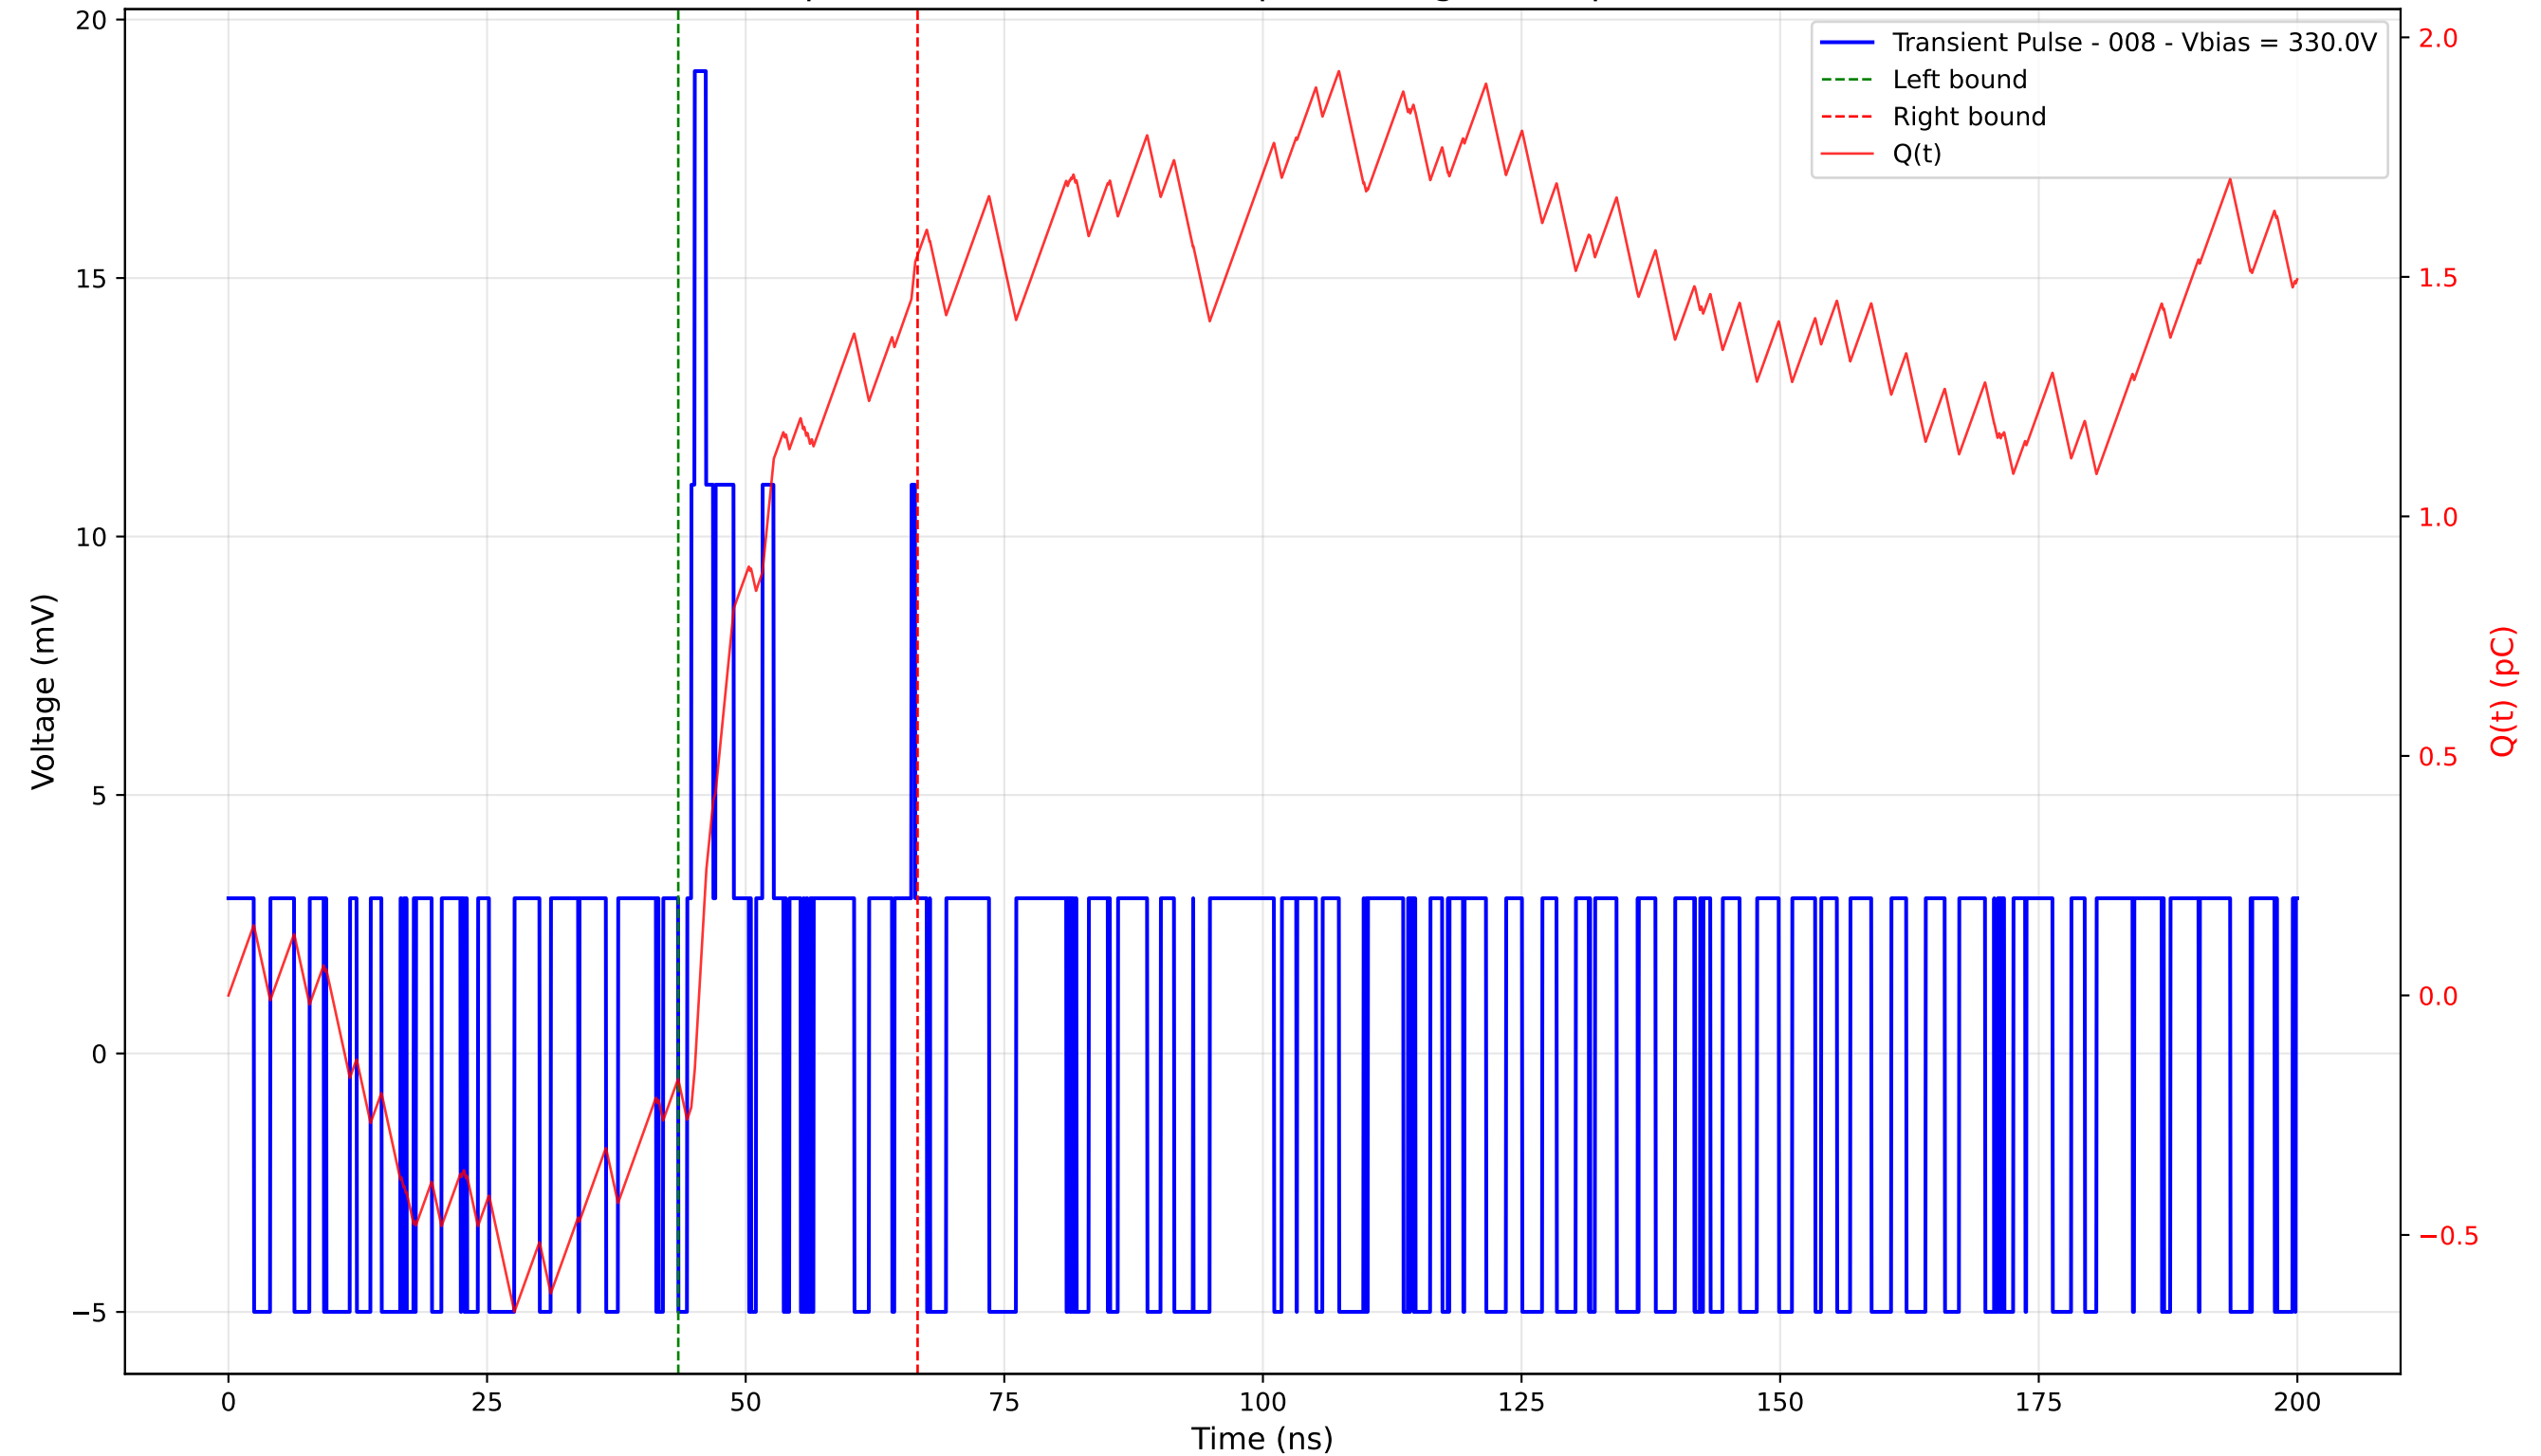


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 0.89 pC - Rise Time: 0.00 ns (N/A)

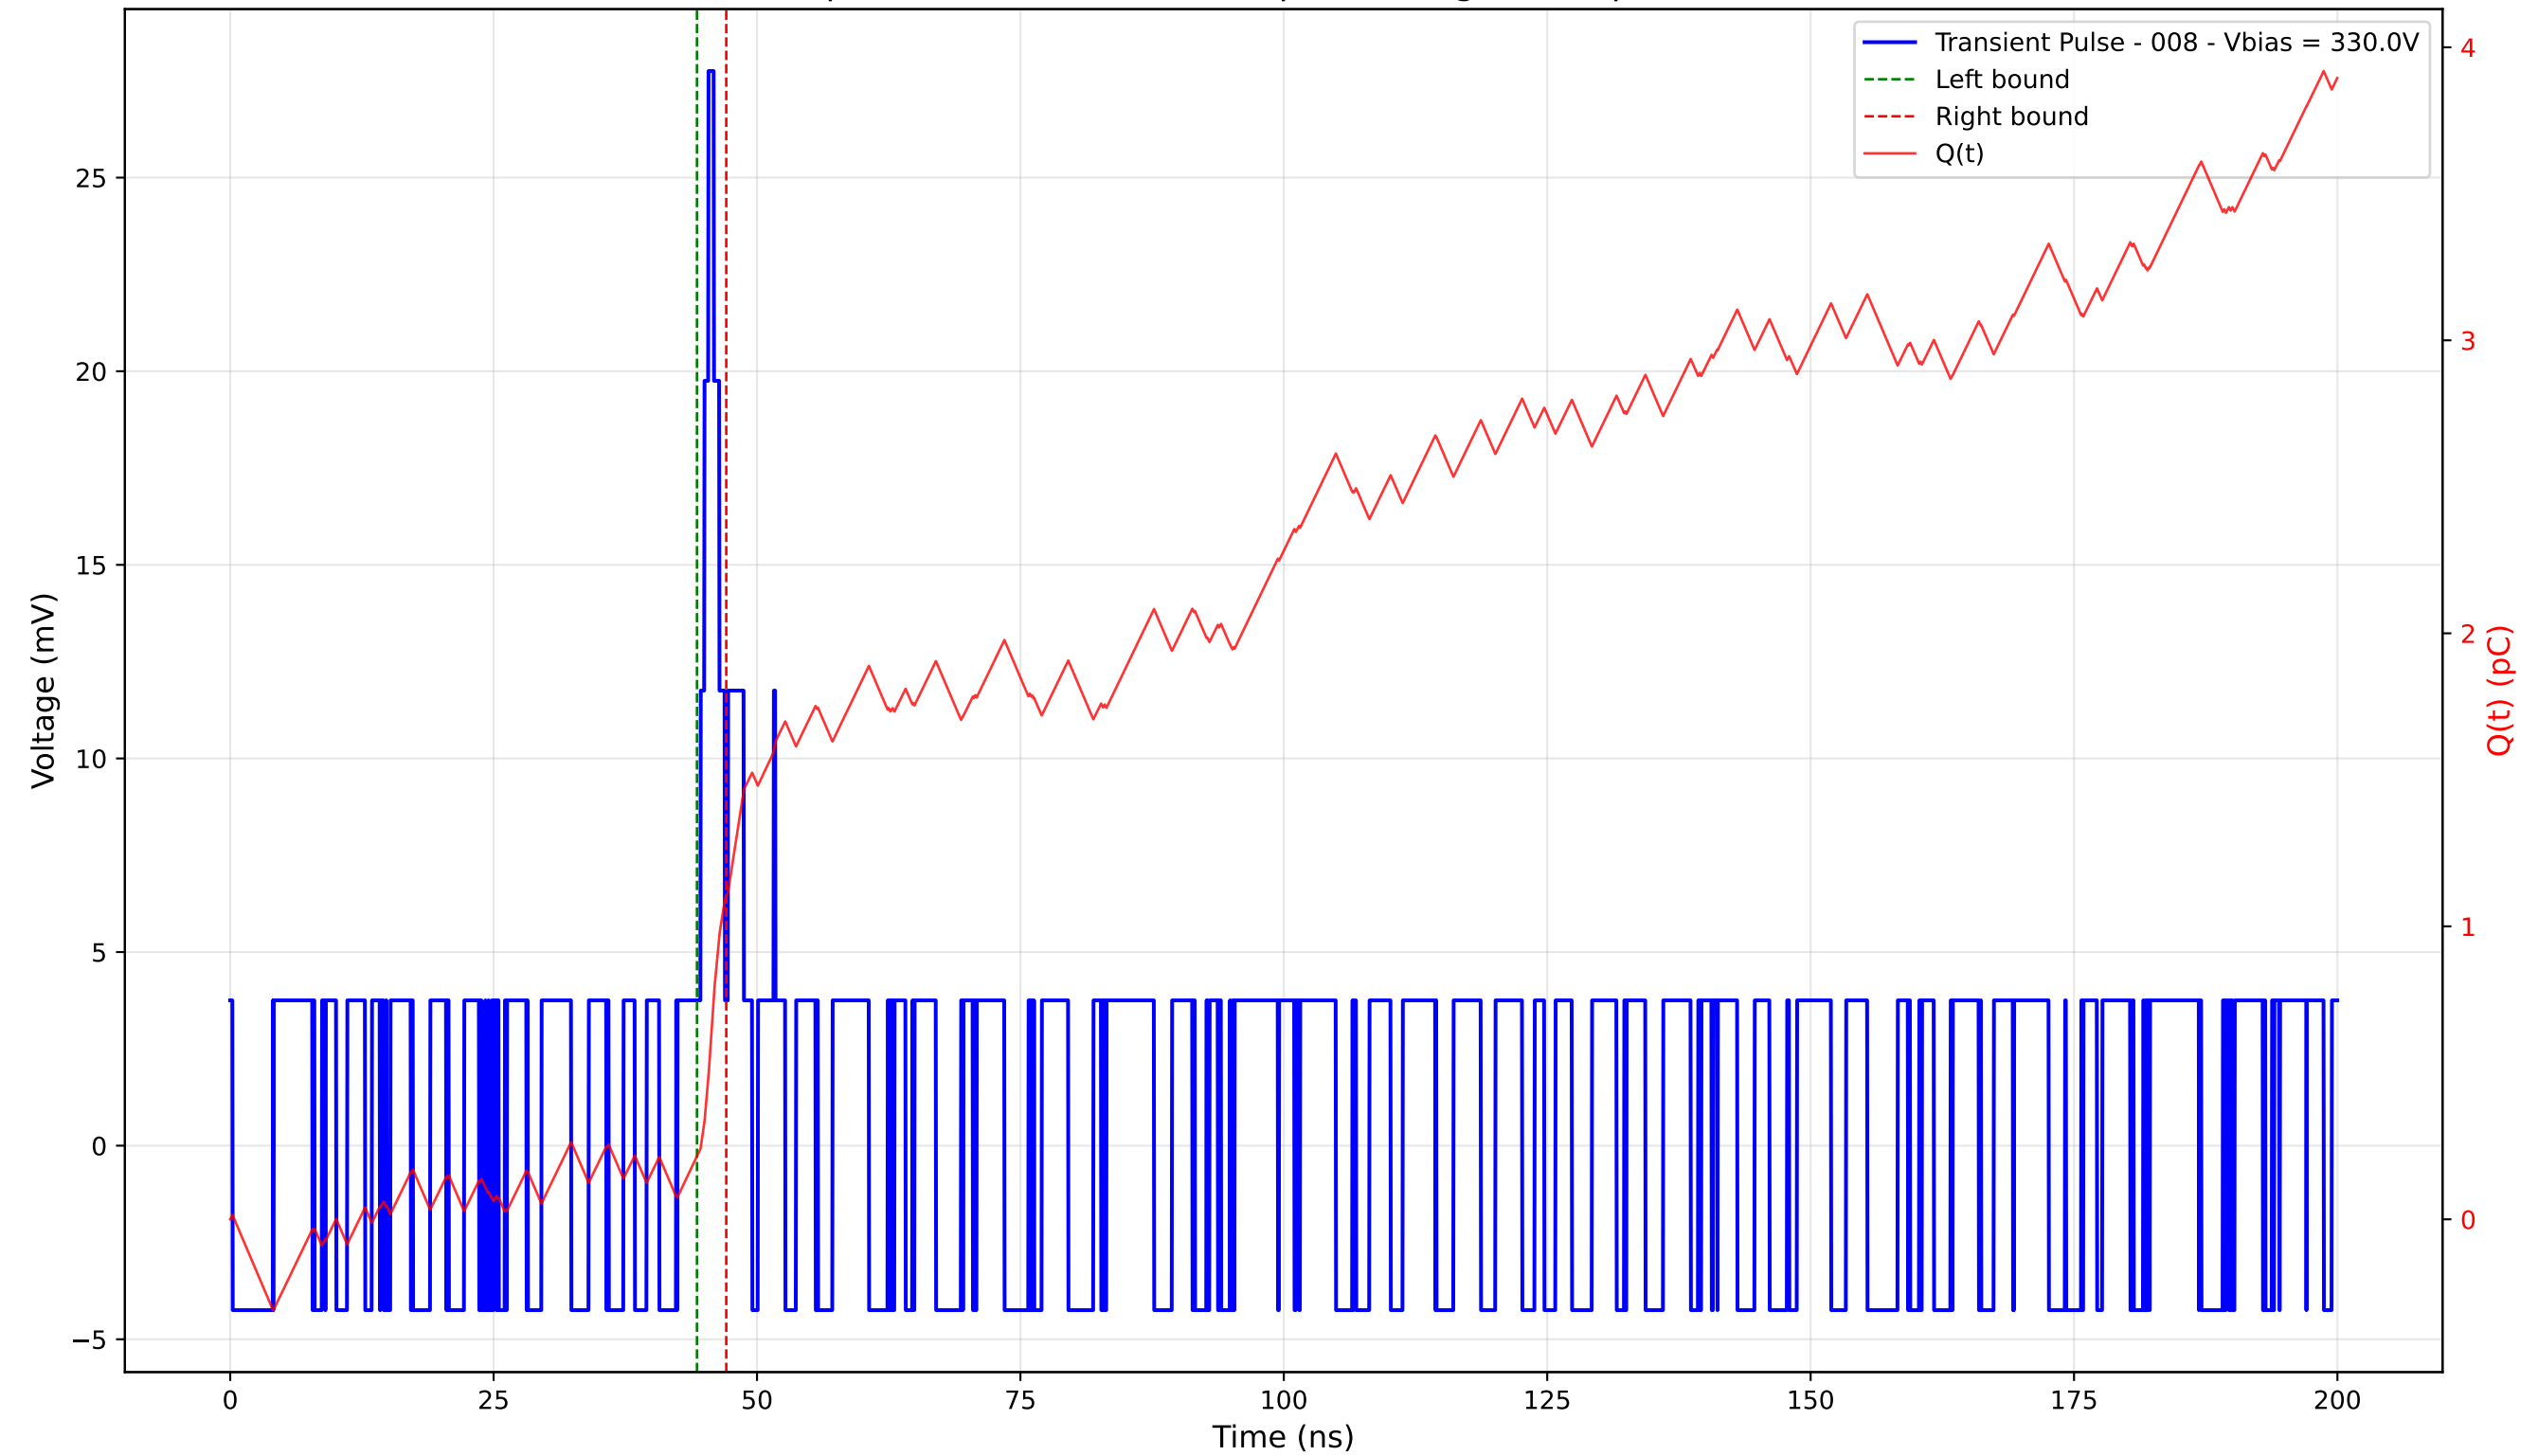


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 1.94 pC - Rise Time: 0.74 ns

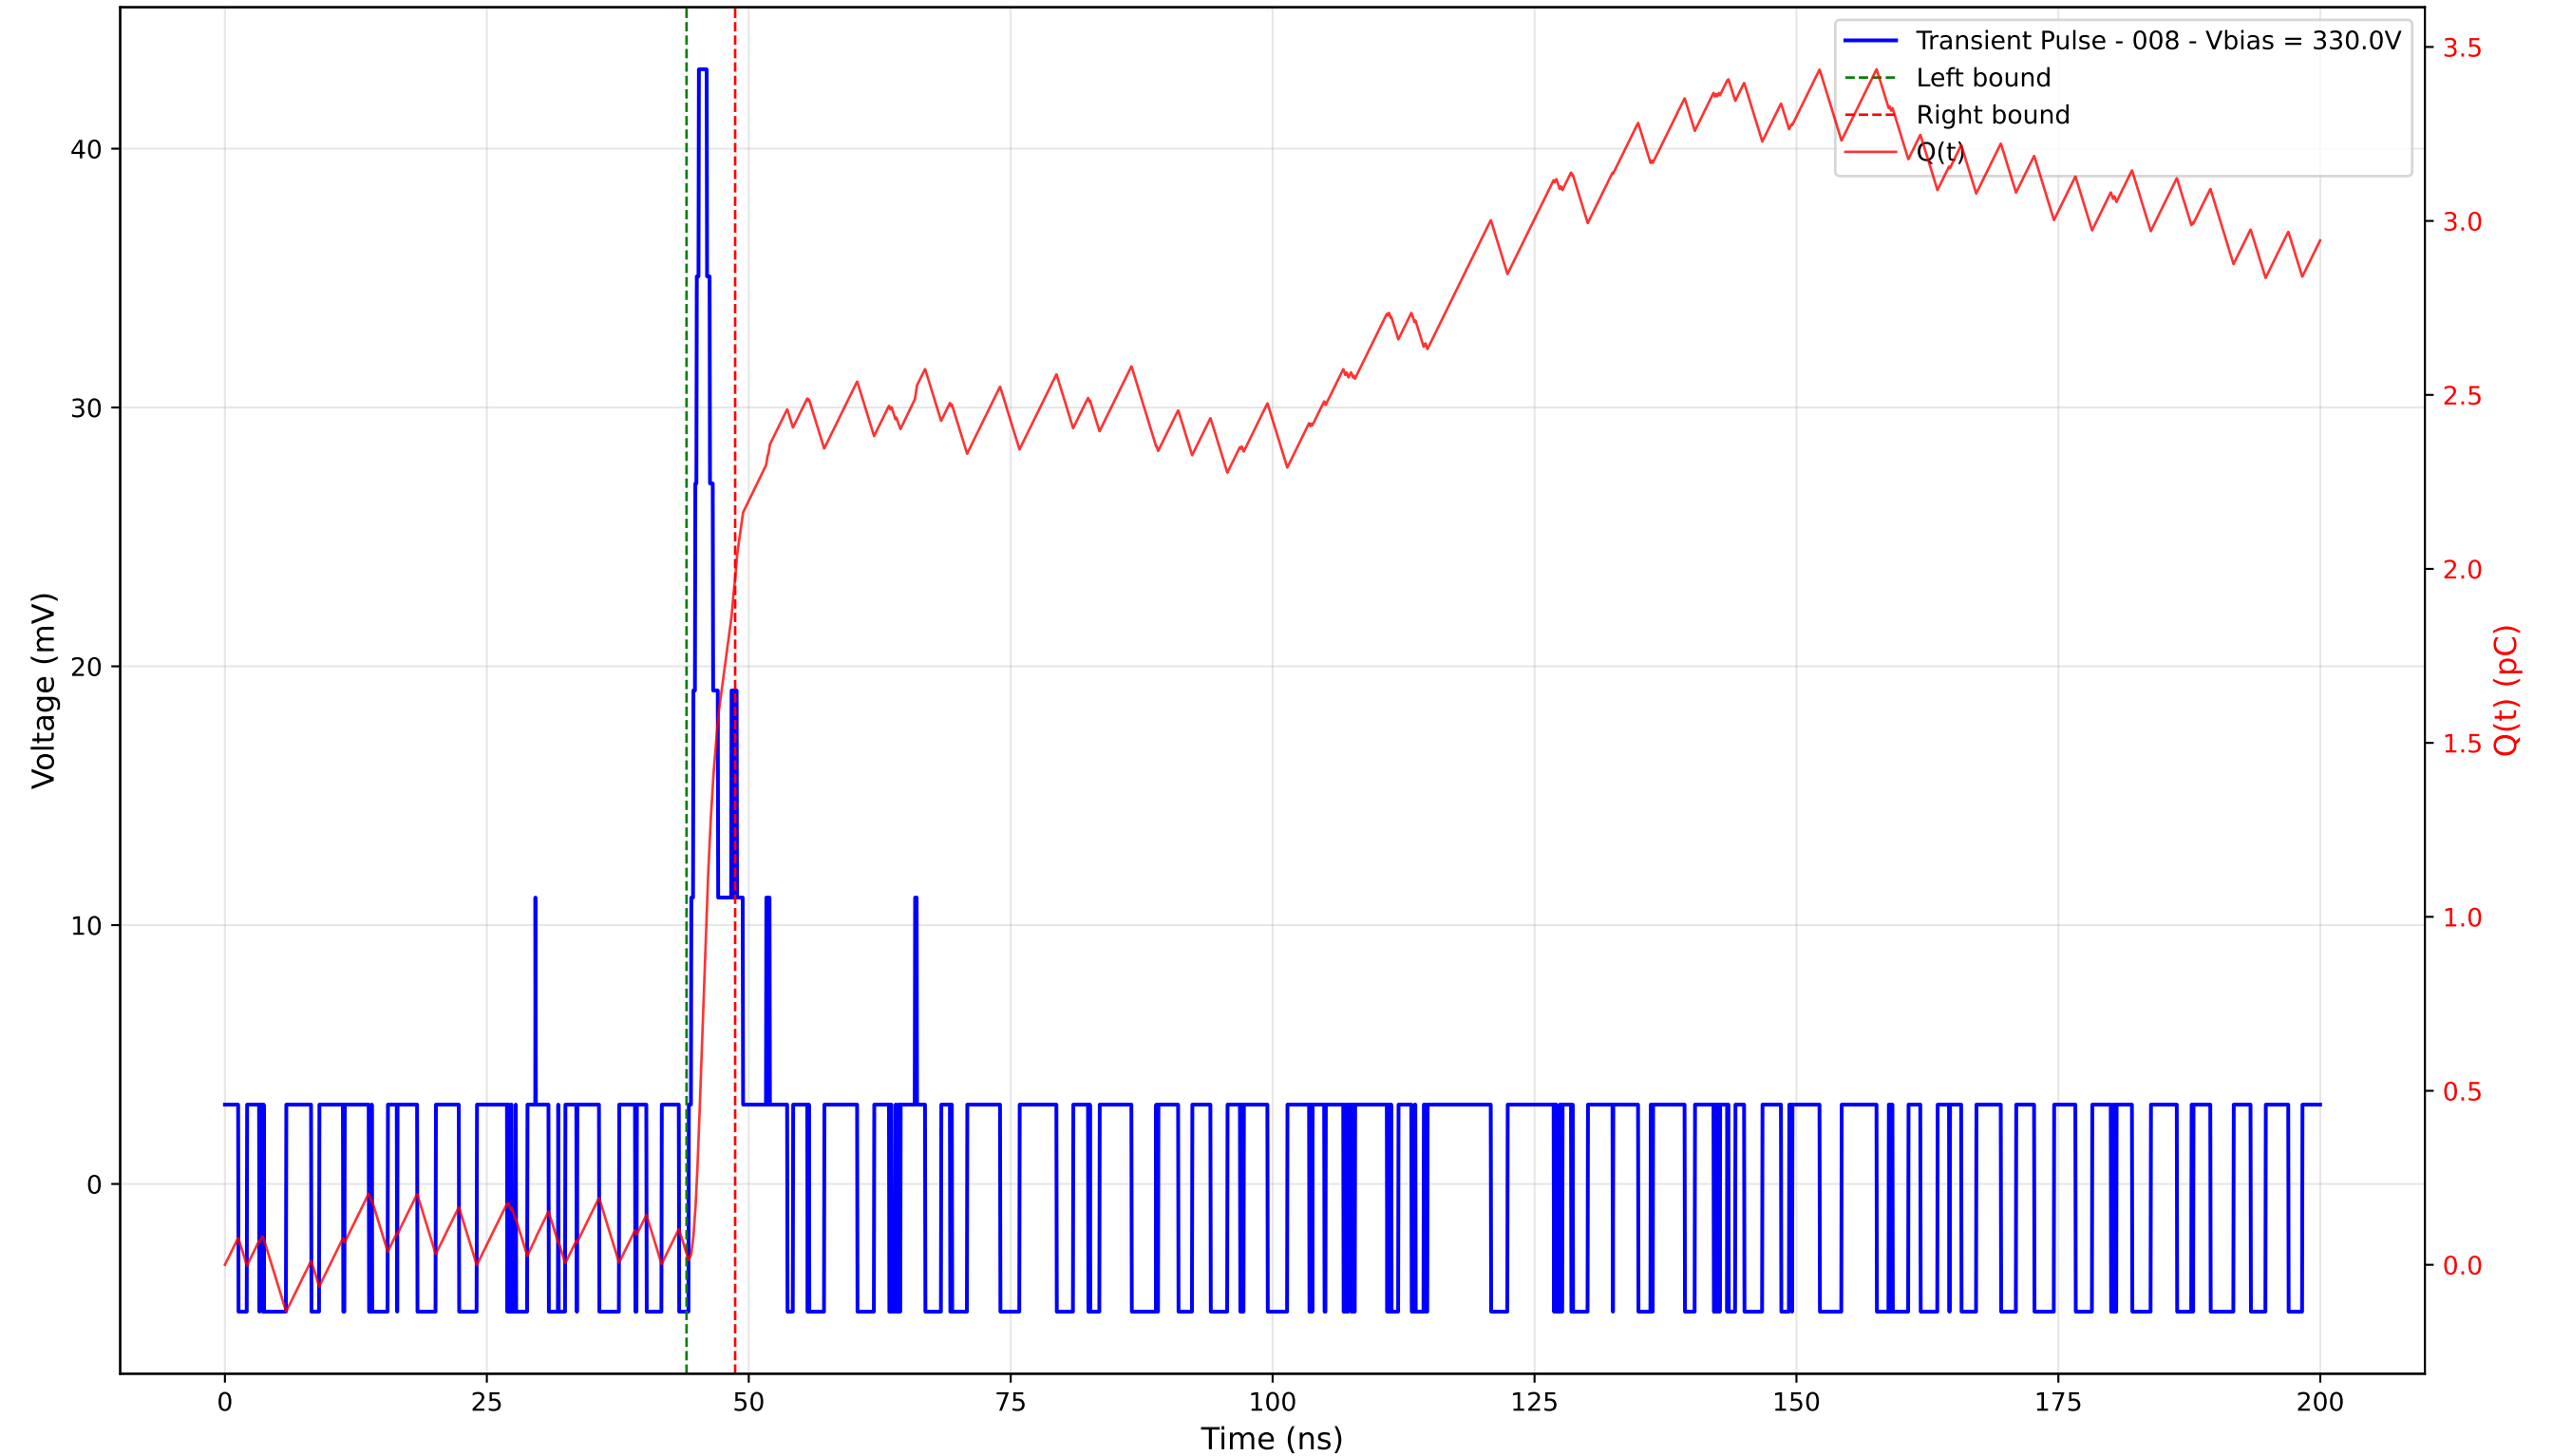


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 4.51 pC - Rise Time: 0.93 ns

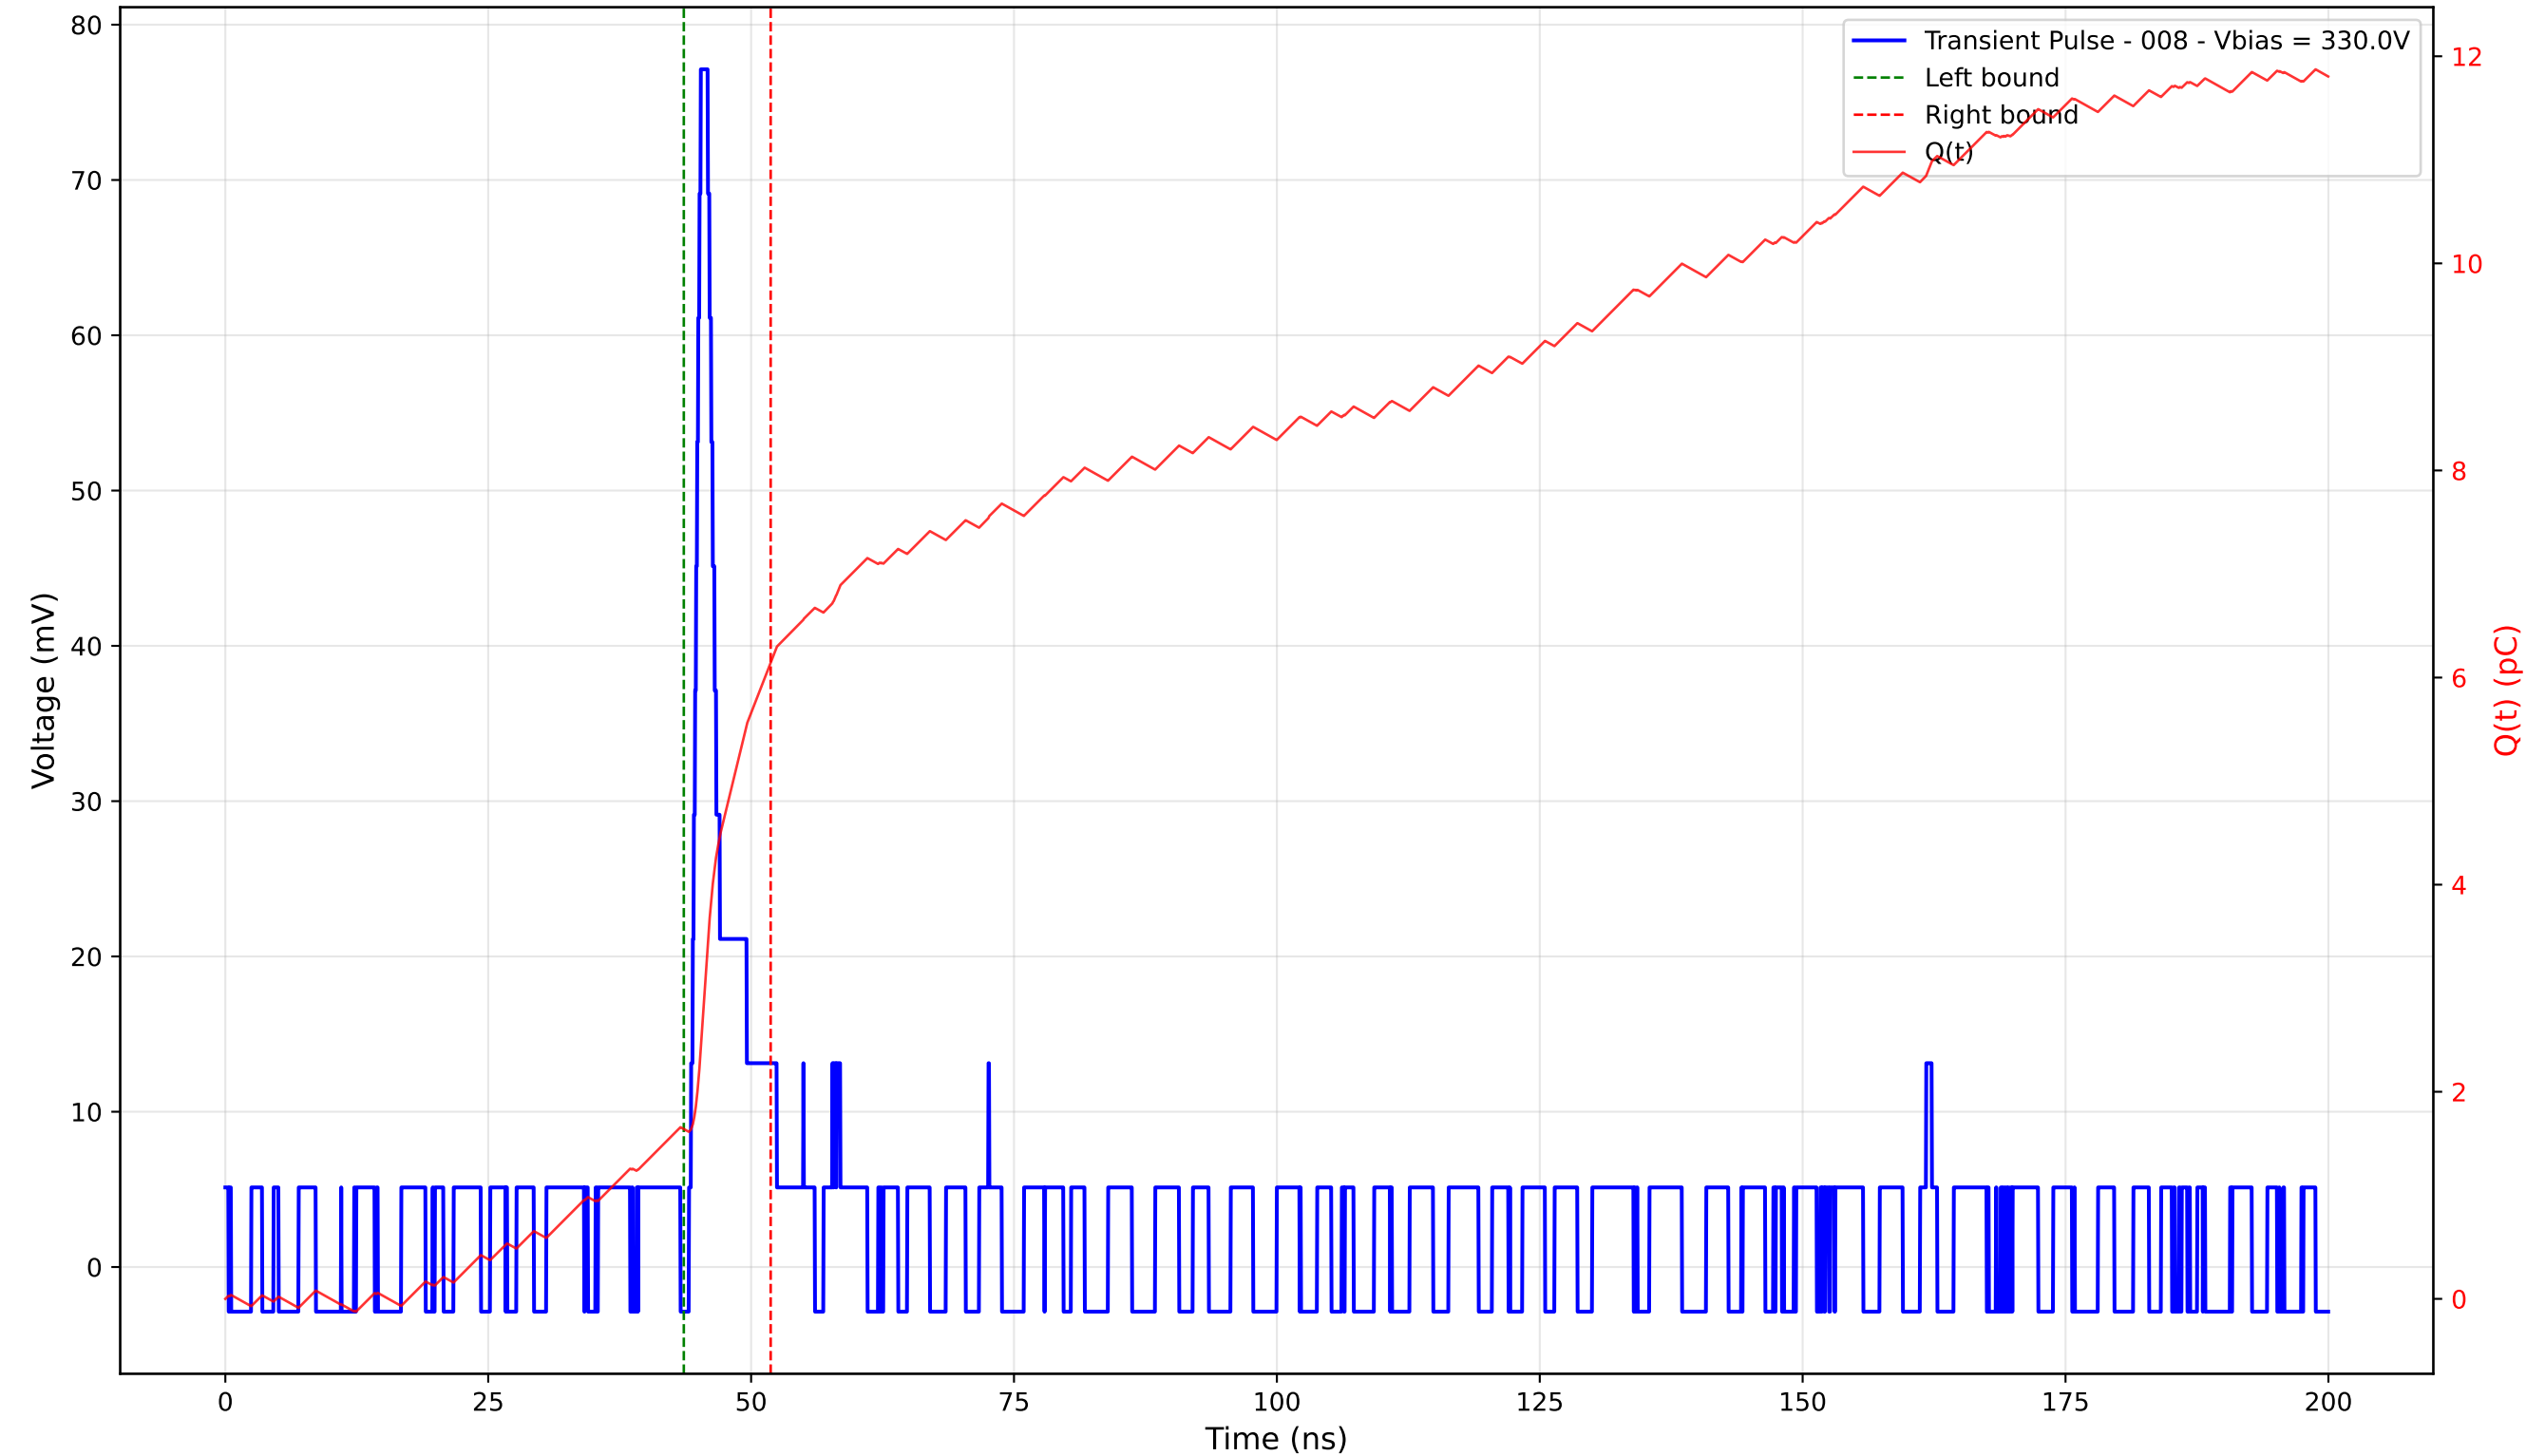


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 8.32 pC - Rise Time: 0.91 ns

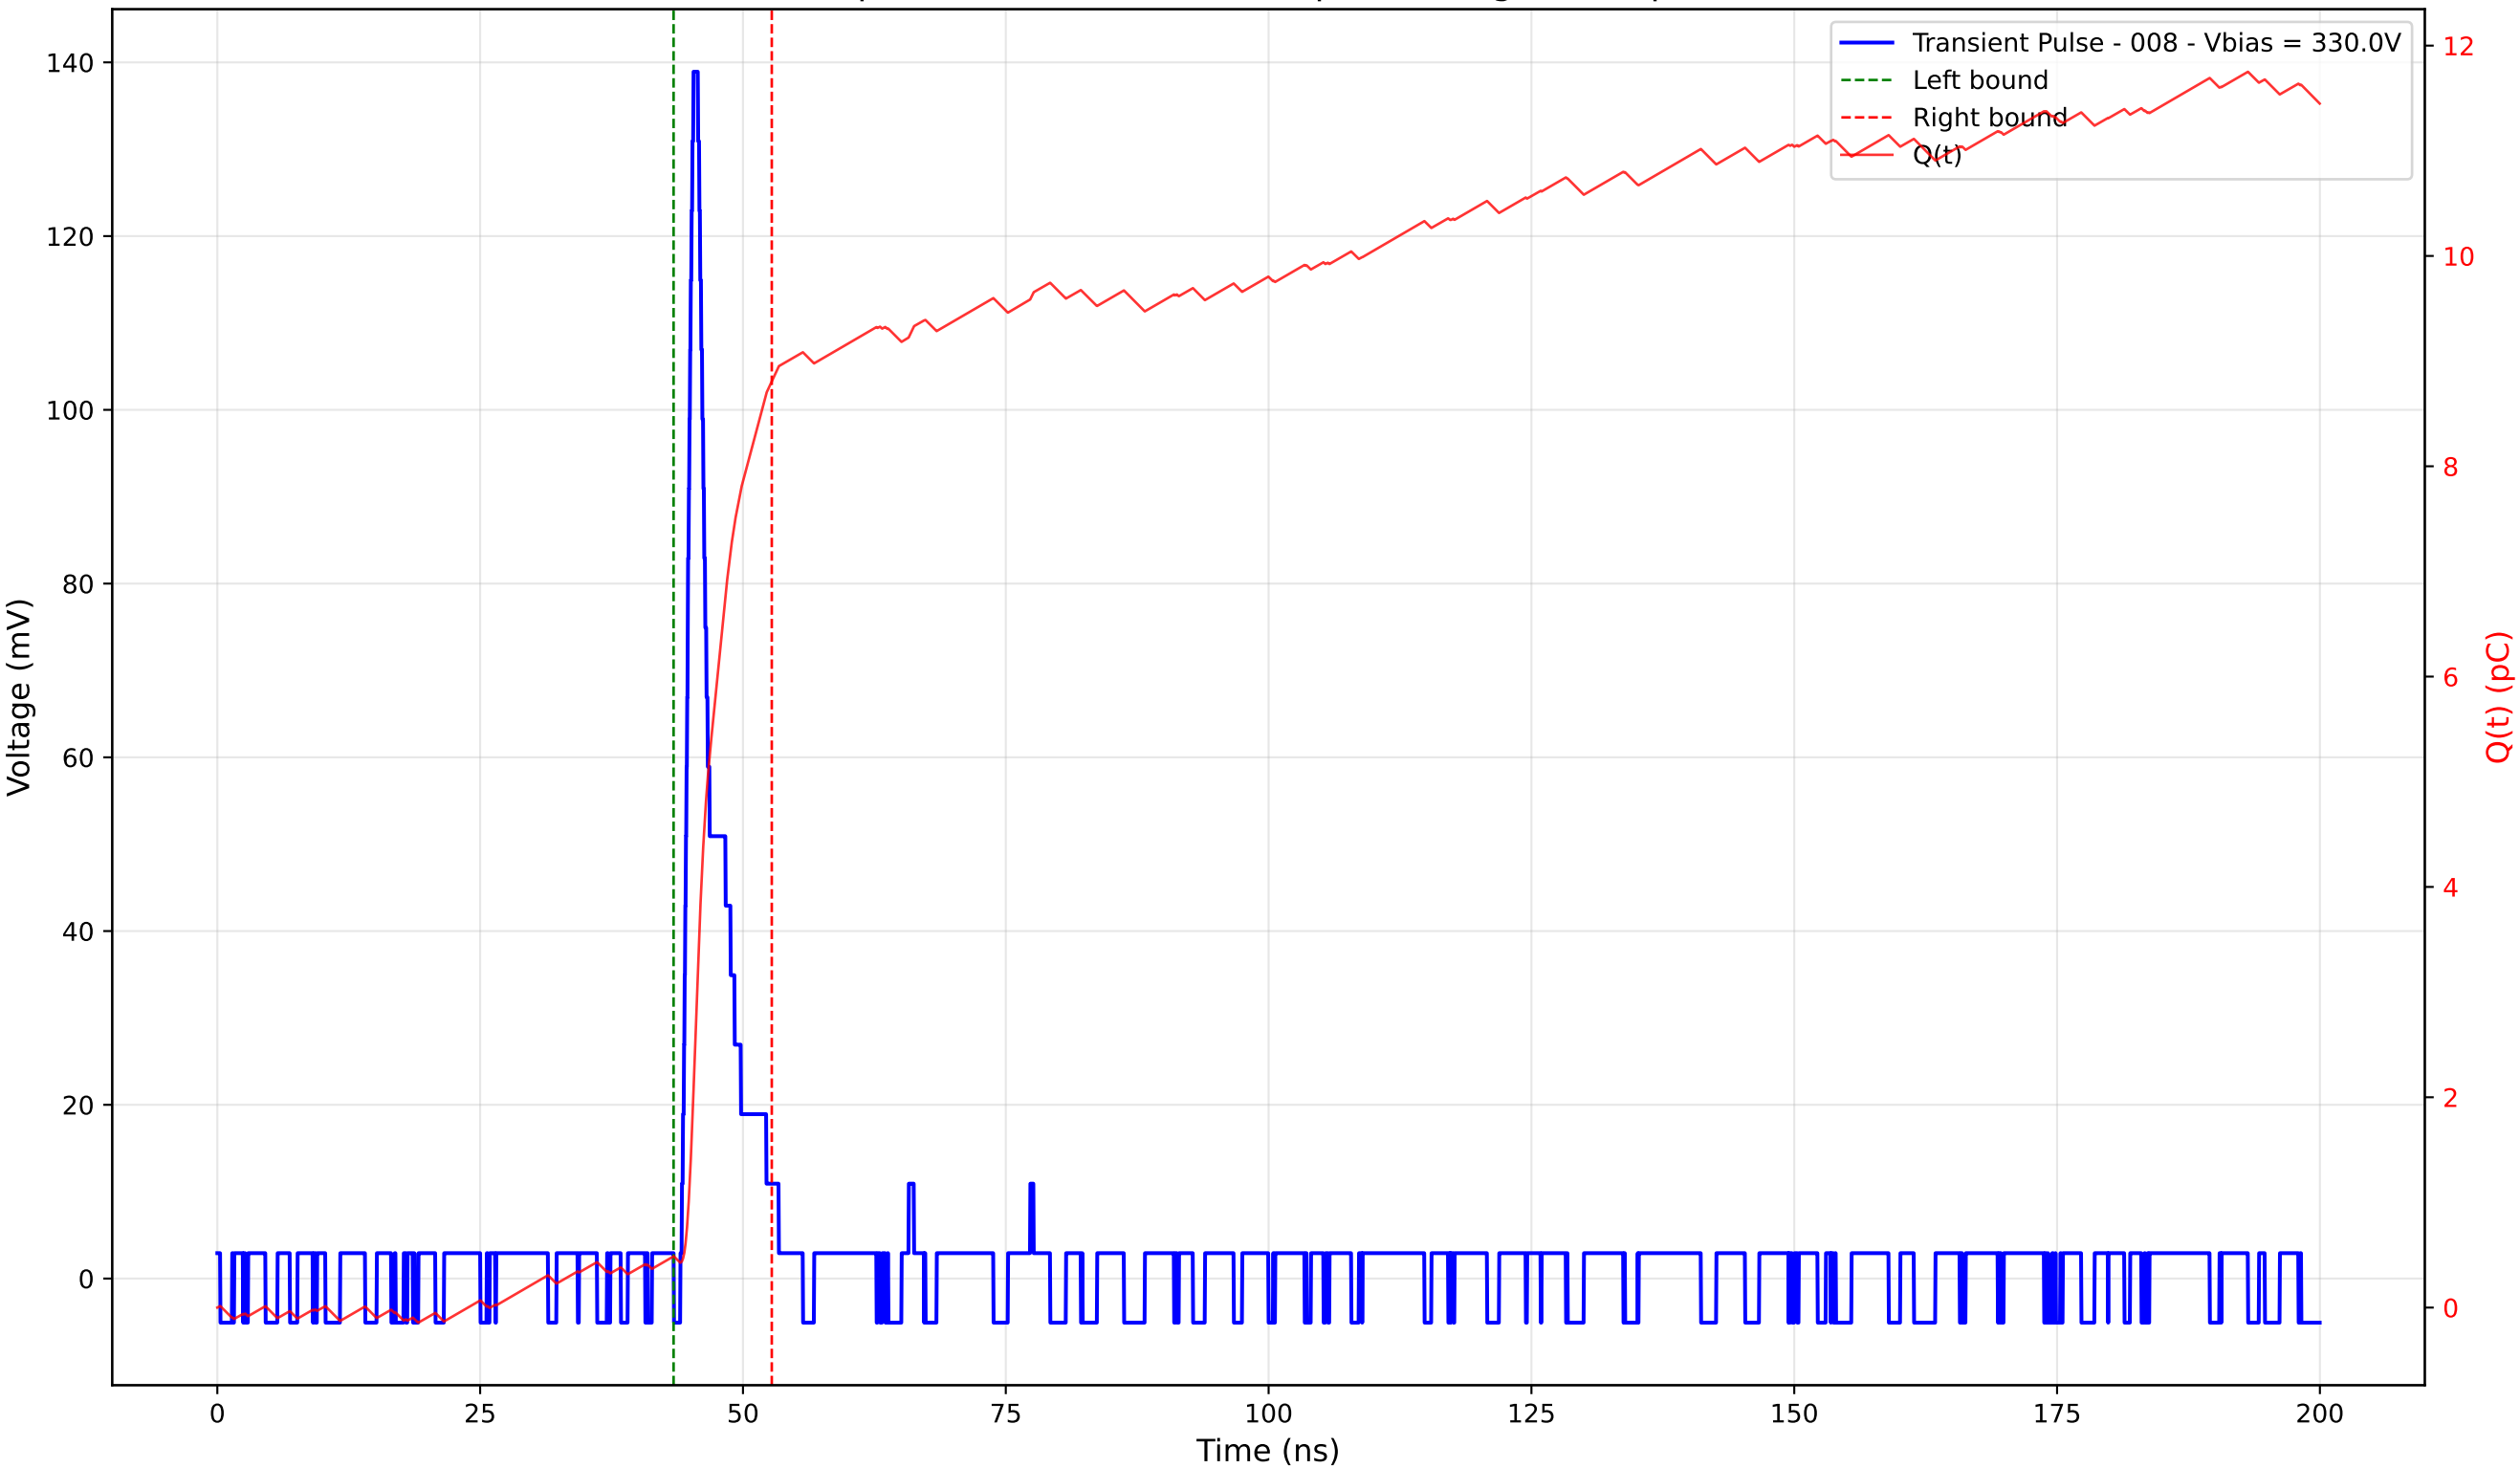


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 12.99 pC - Rise Time: 0.87 ns

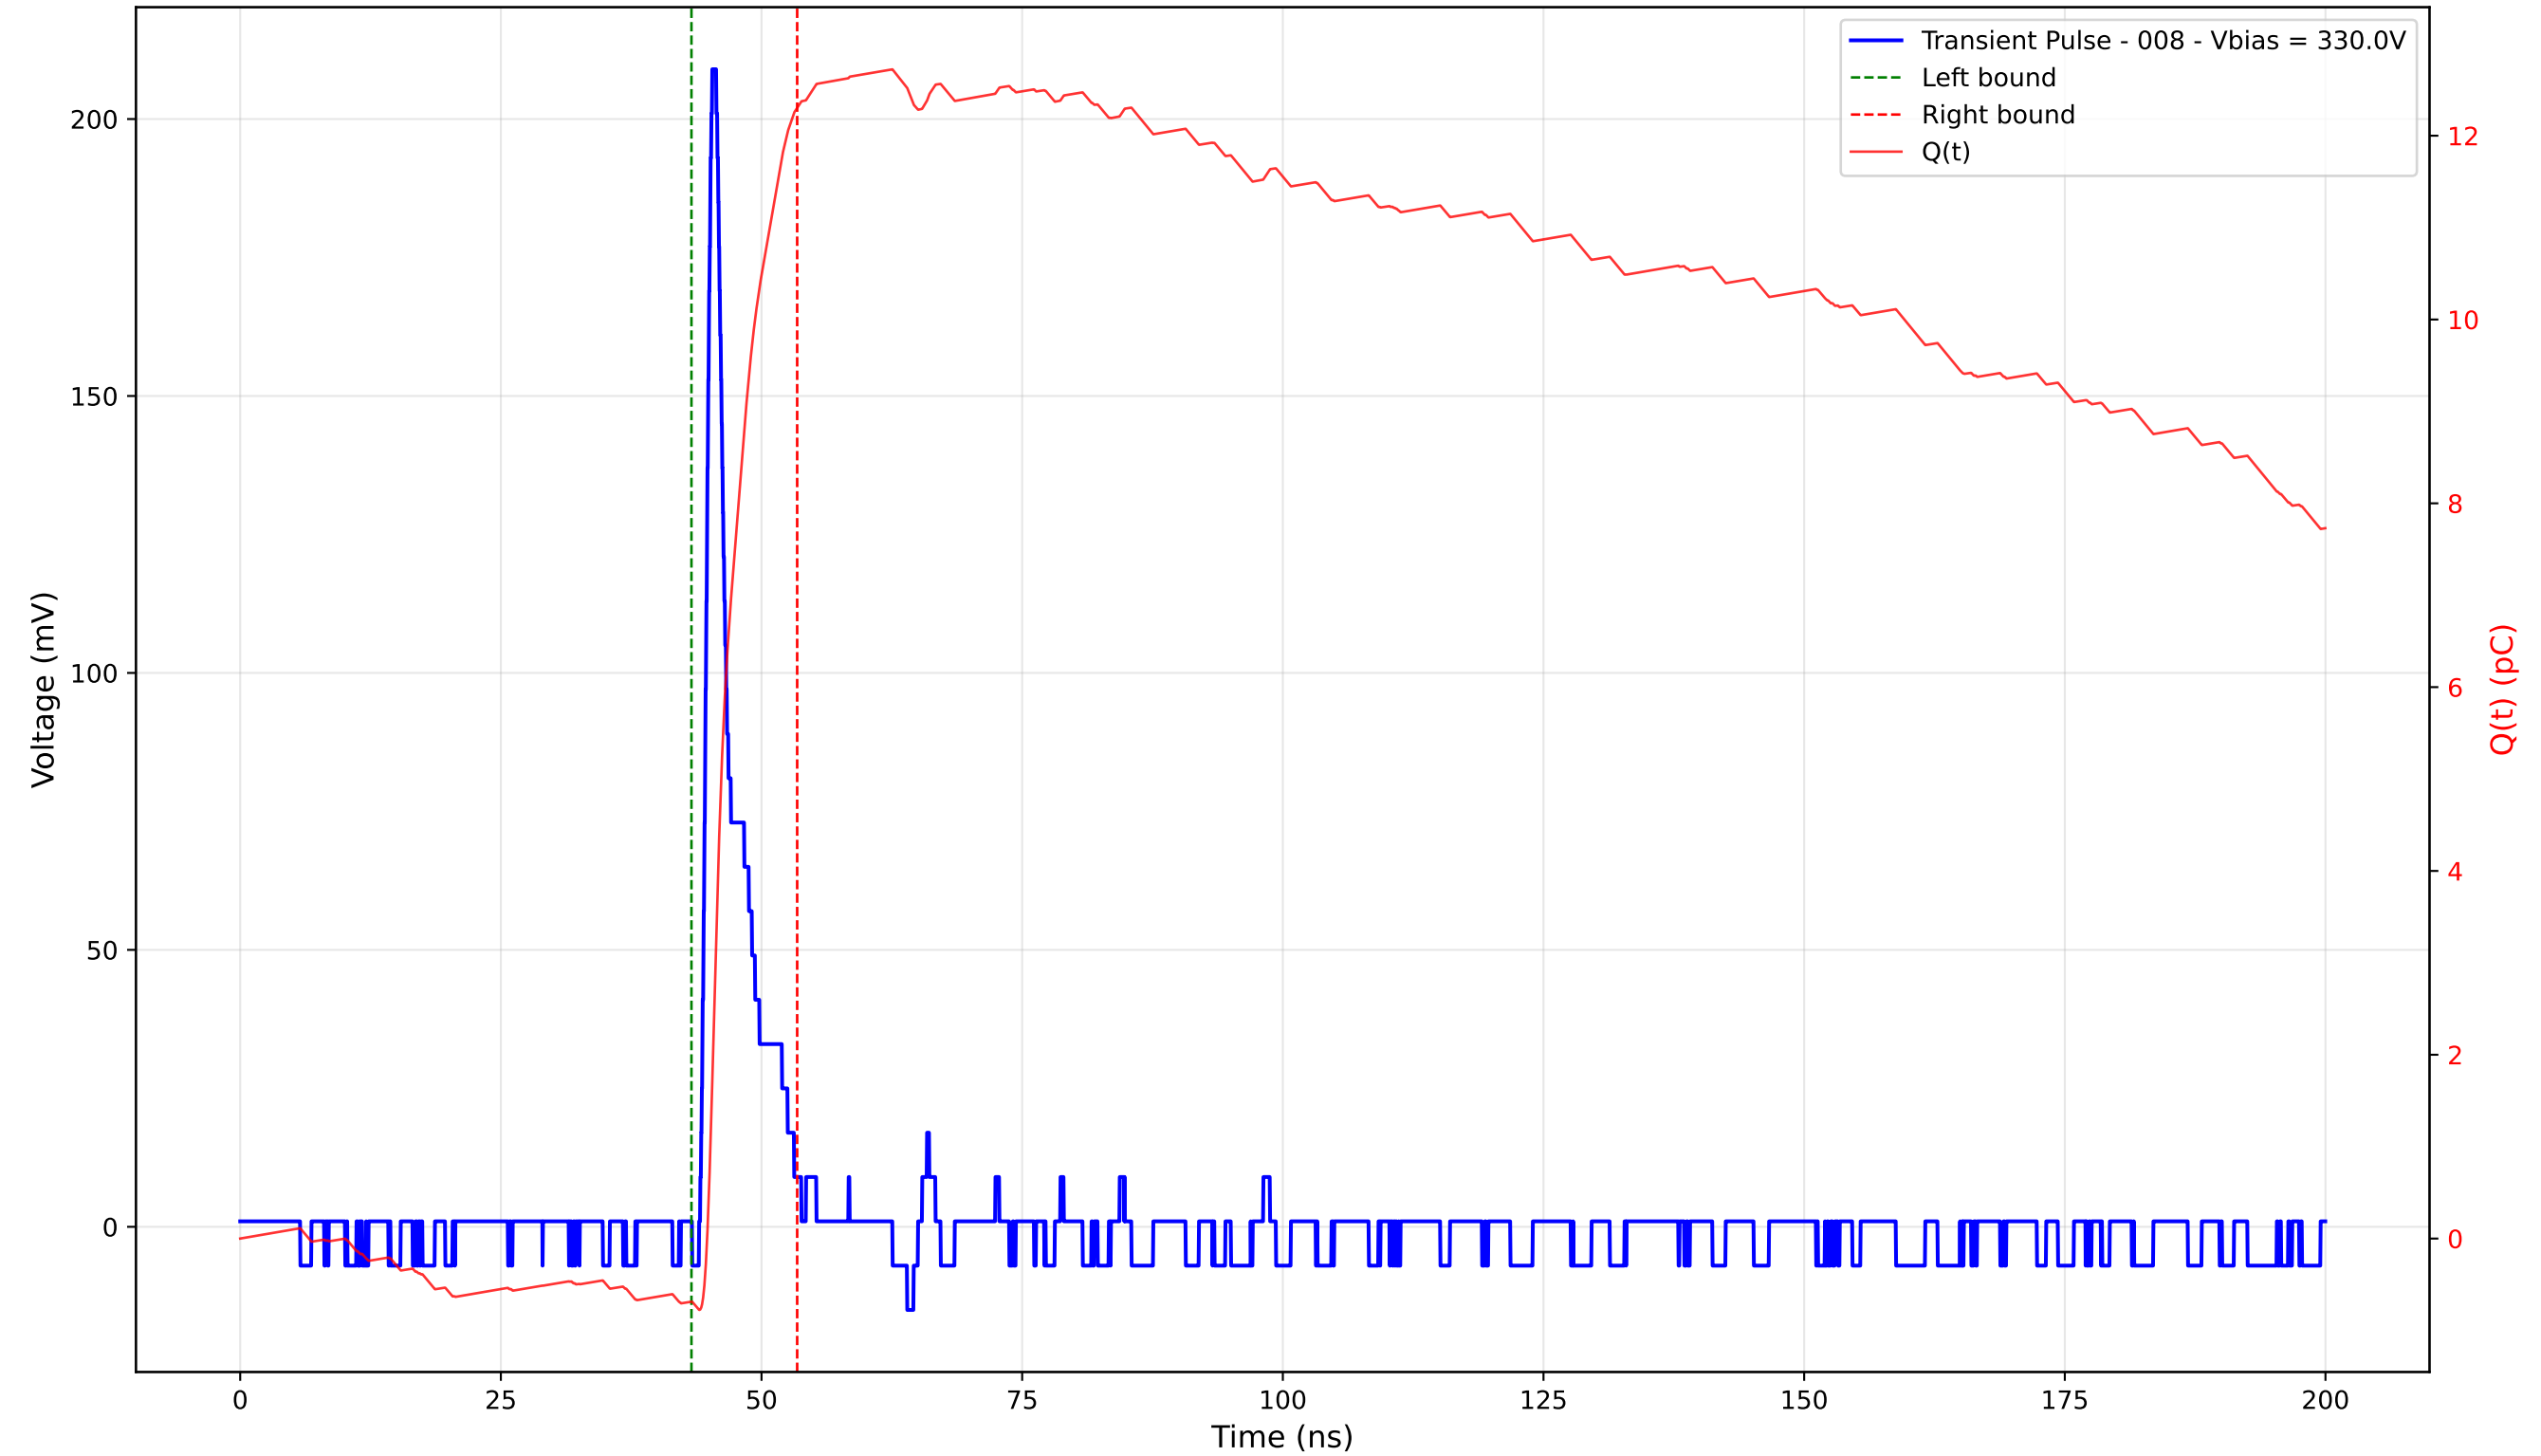


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 18.50 pC - Rise Time: 0.90 ns

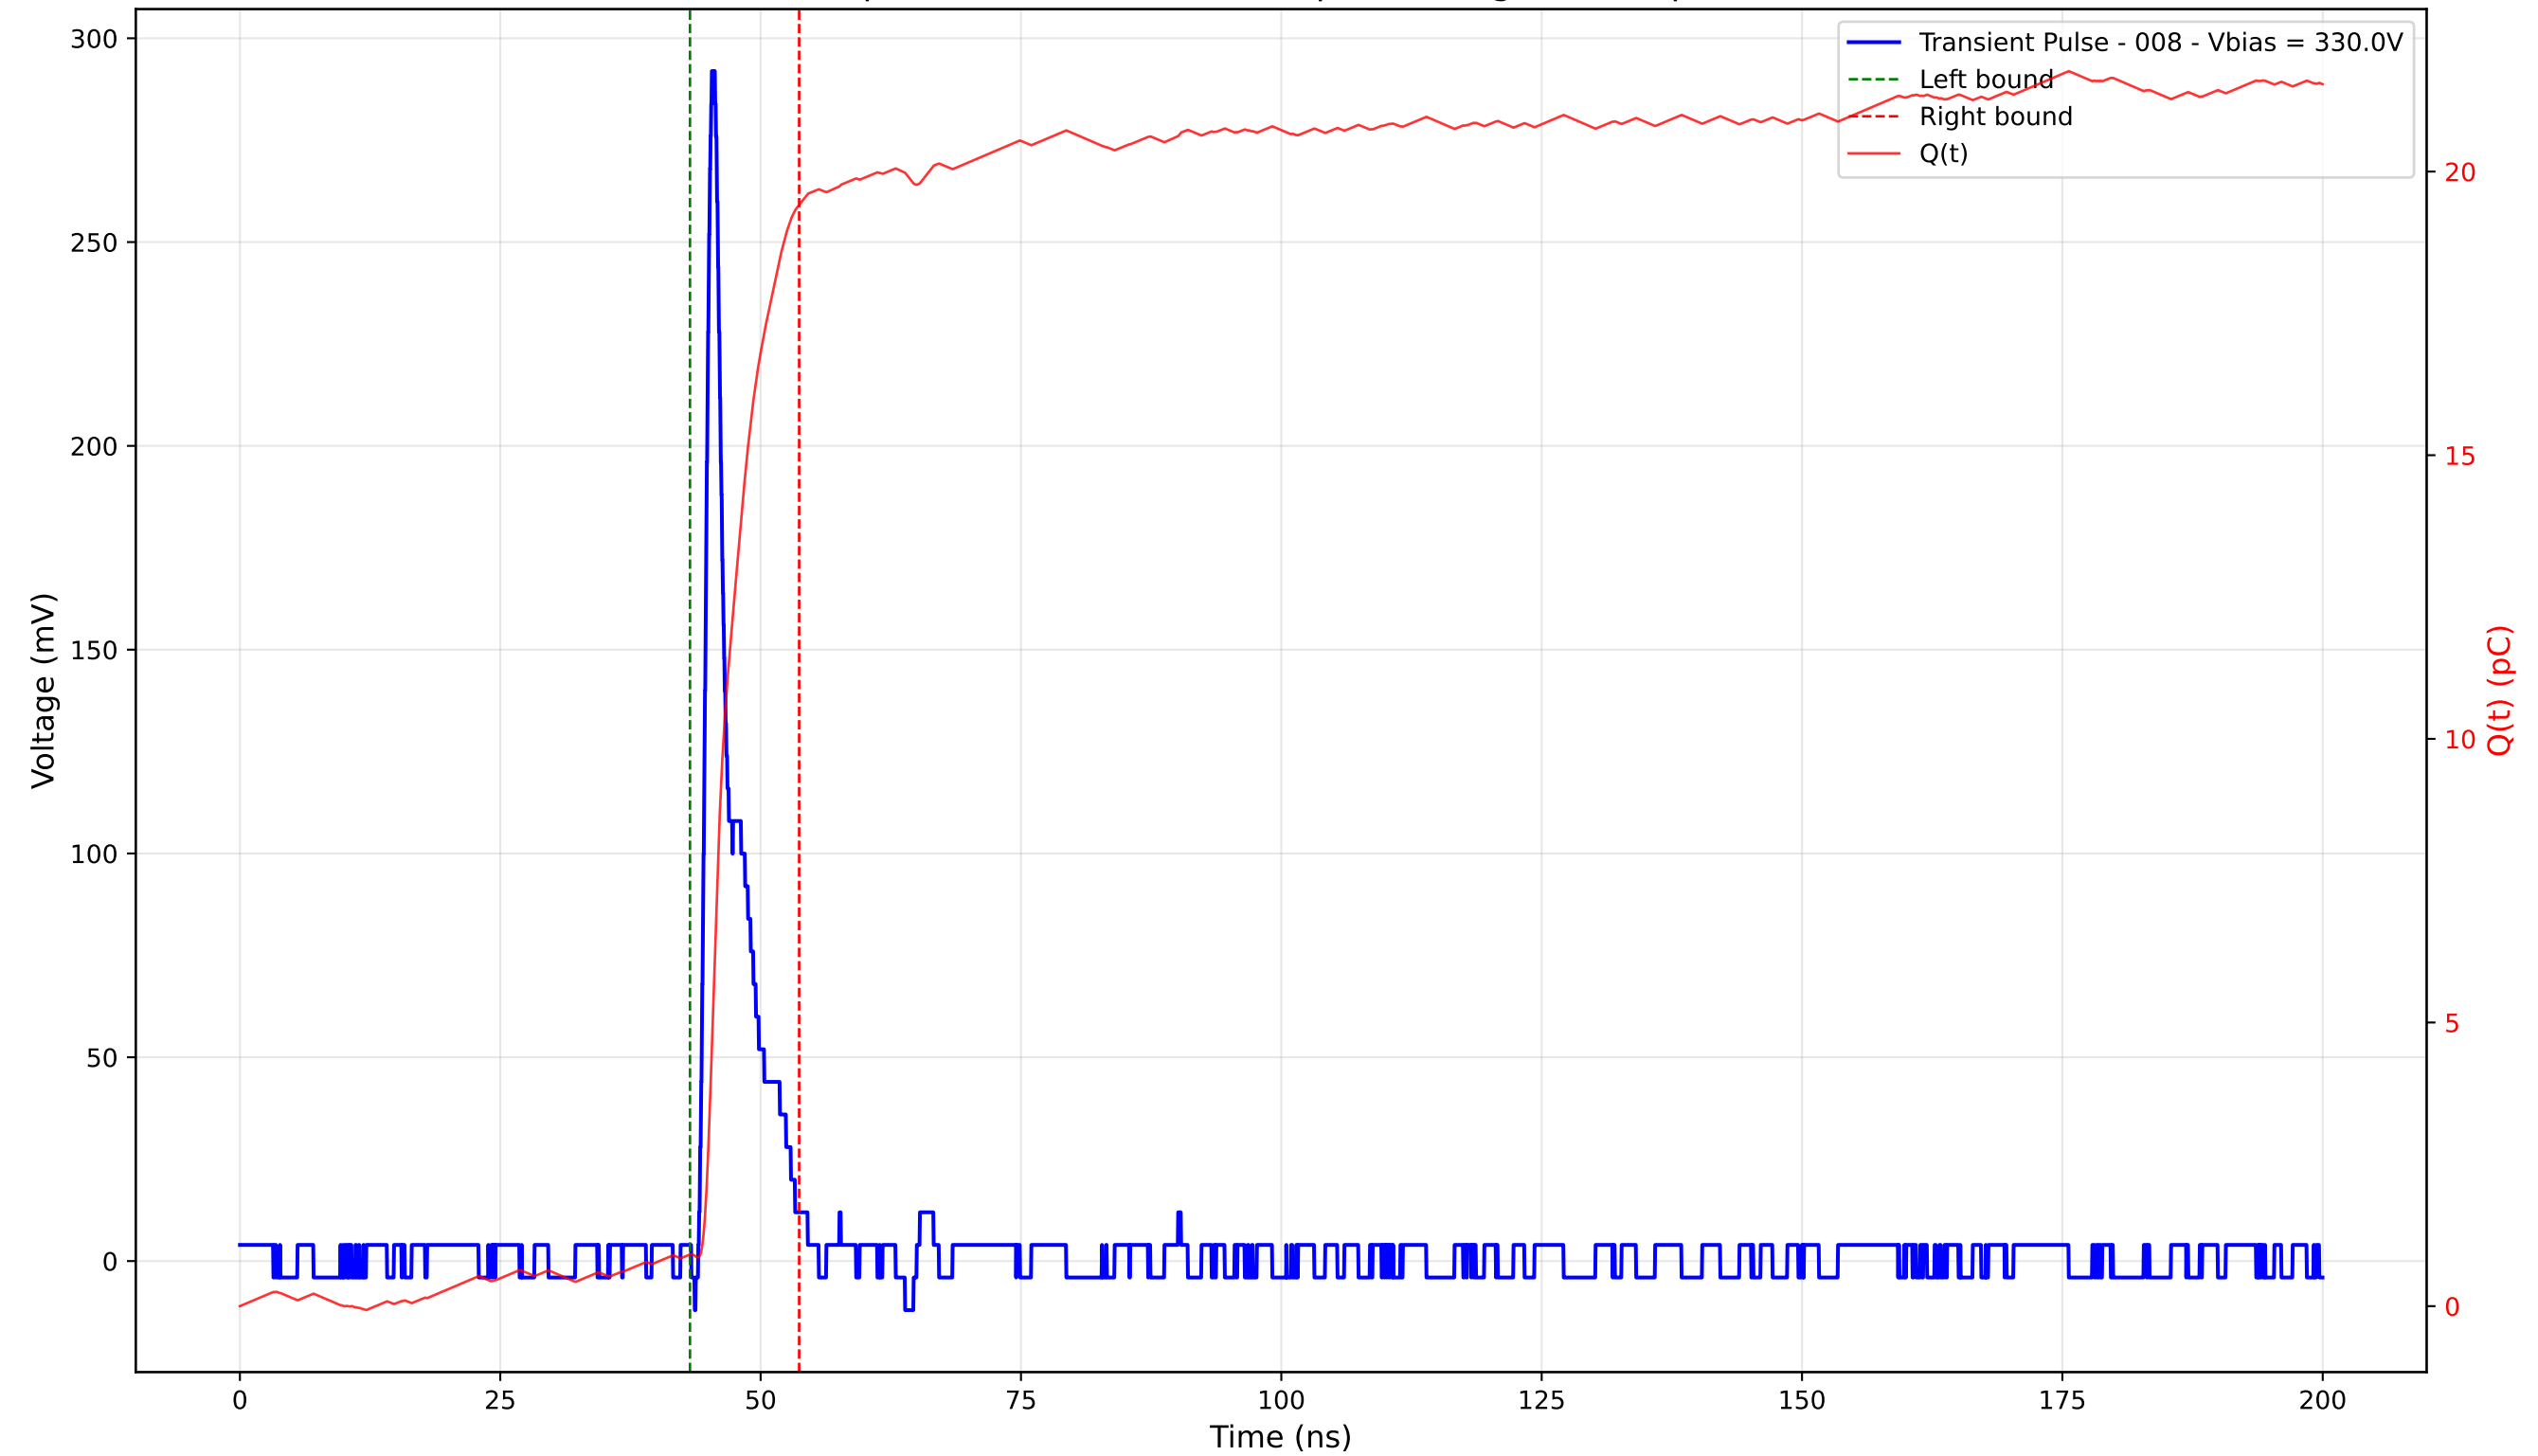


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 23.07 pC - Rise Time: 0.91 ns

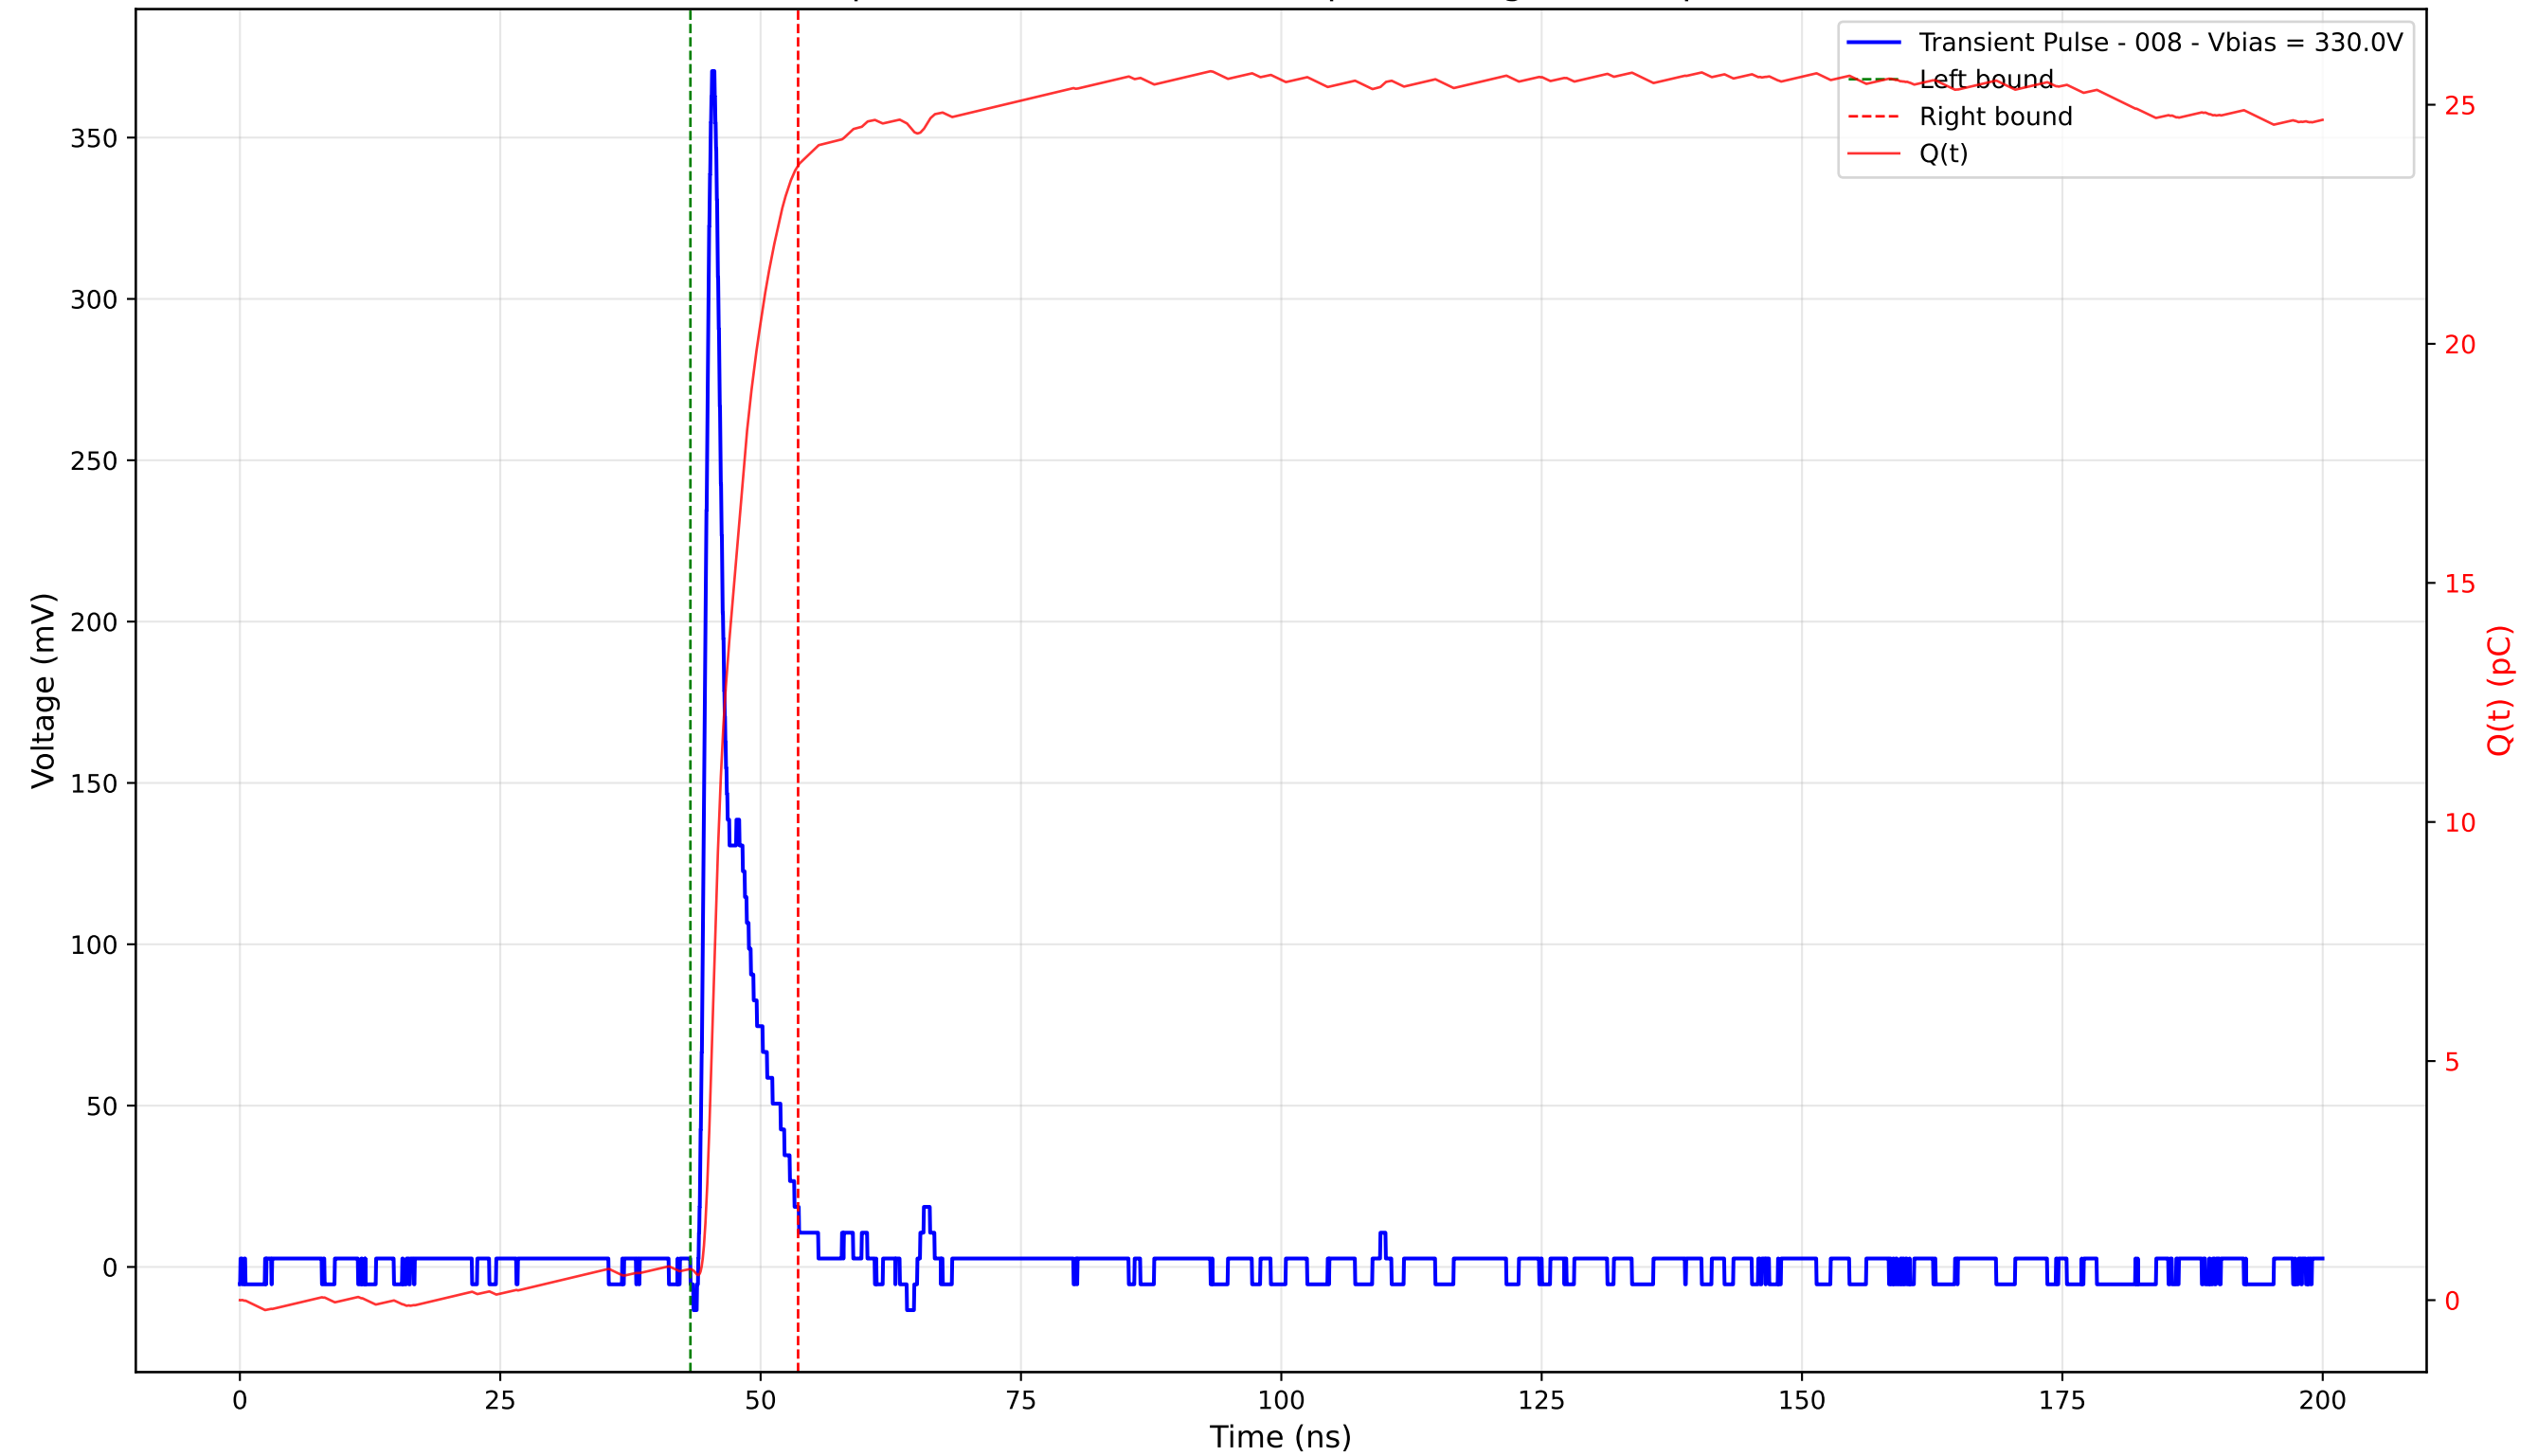


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 28.04 pC - Rise Time: 0.90 ns

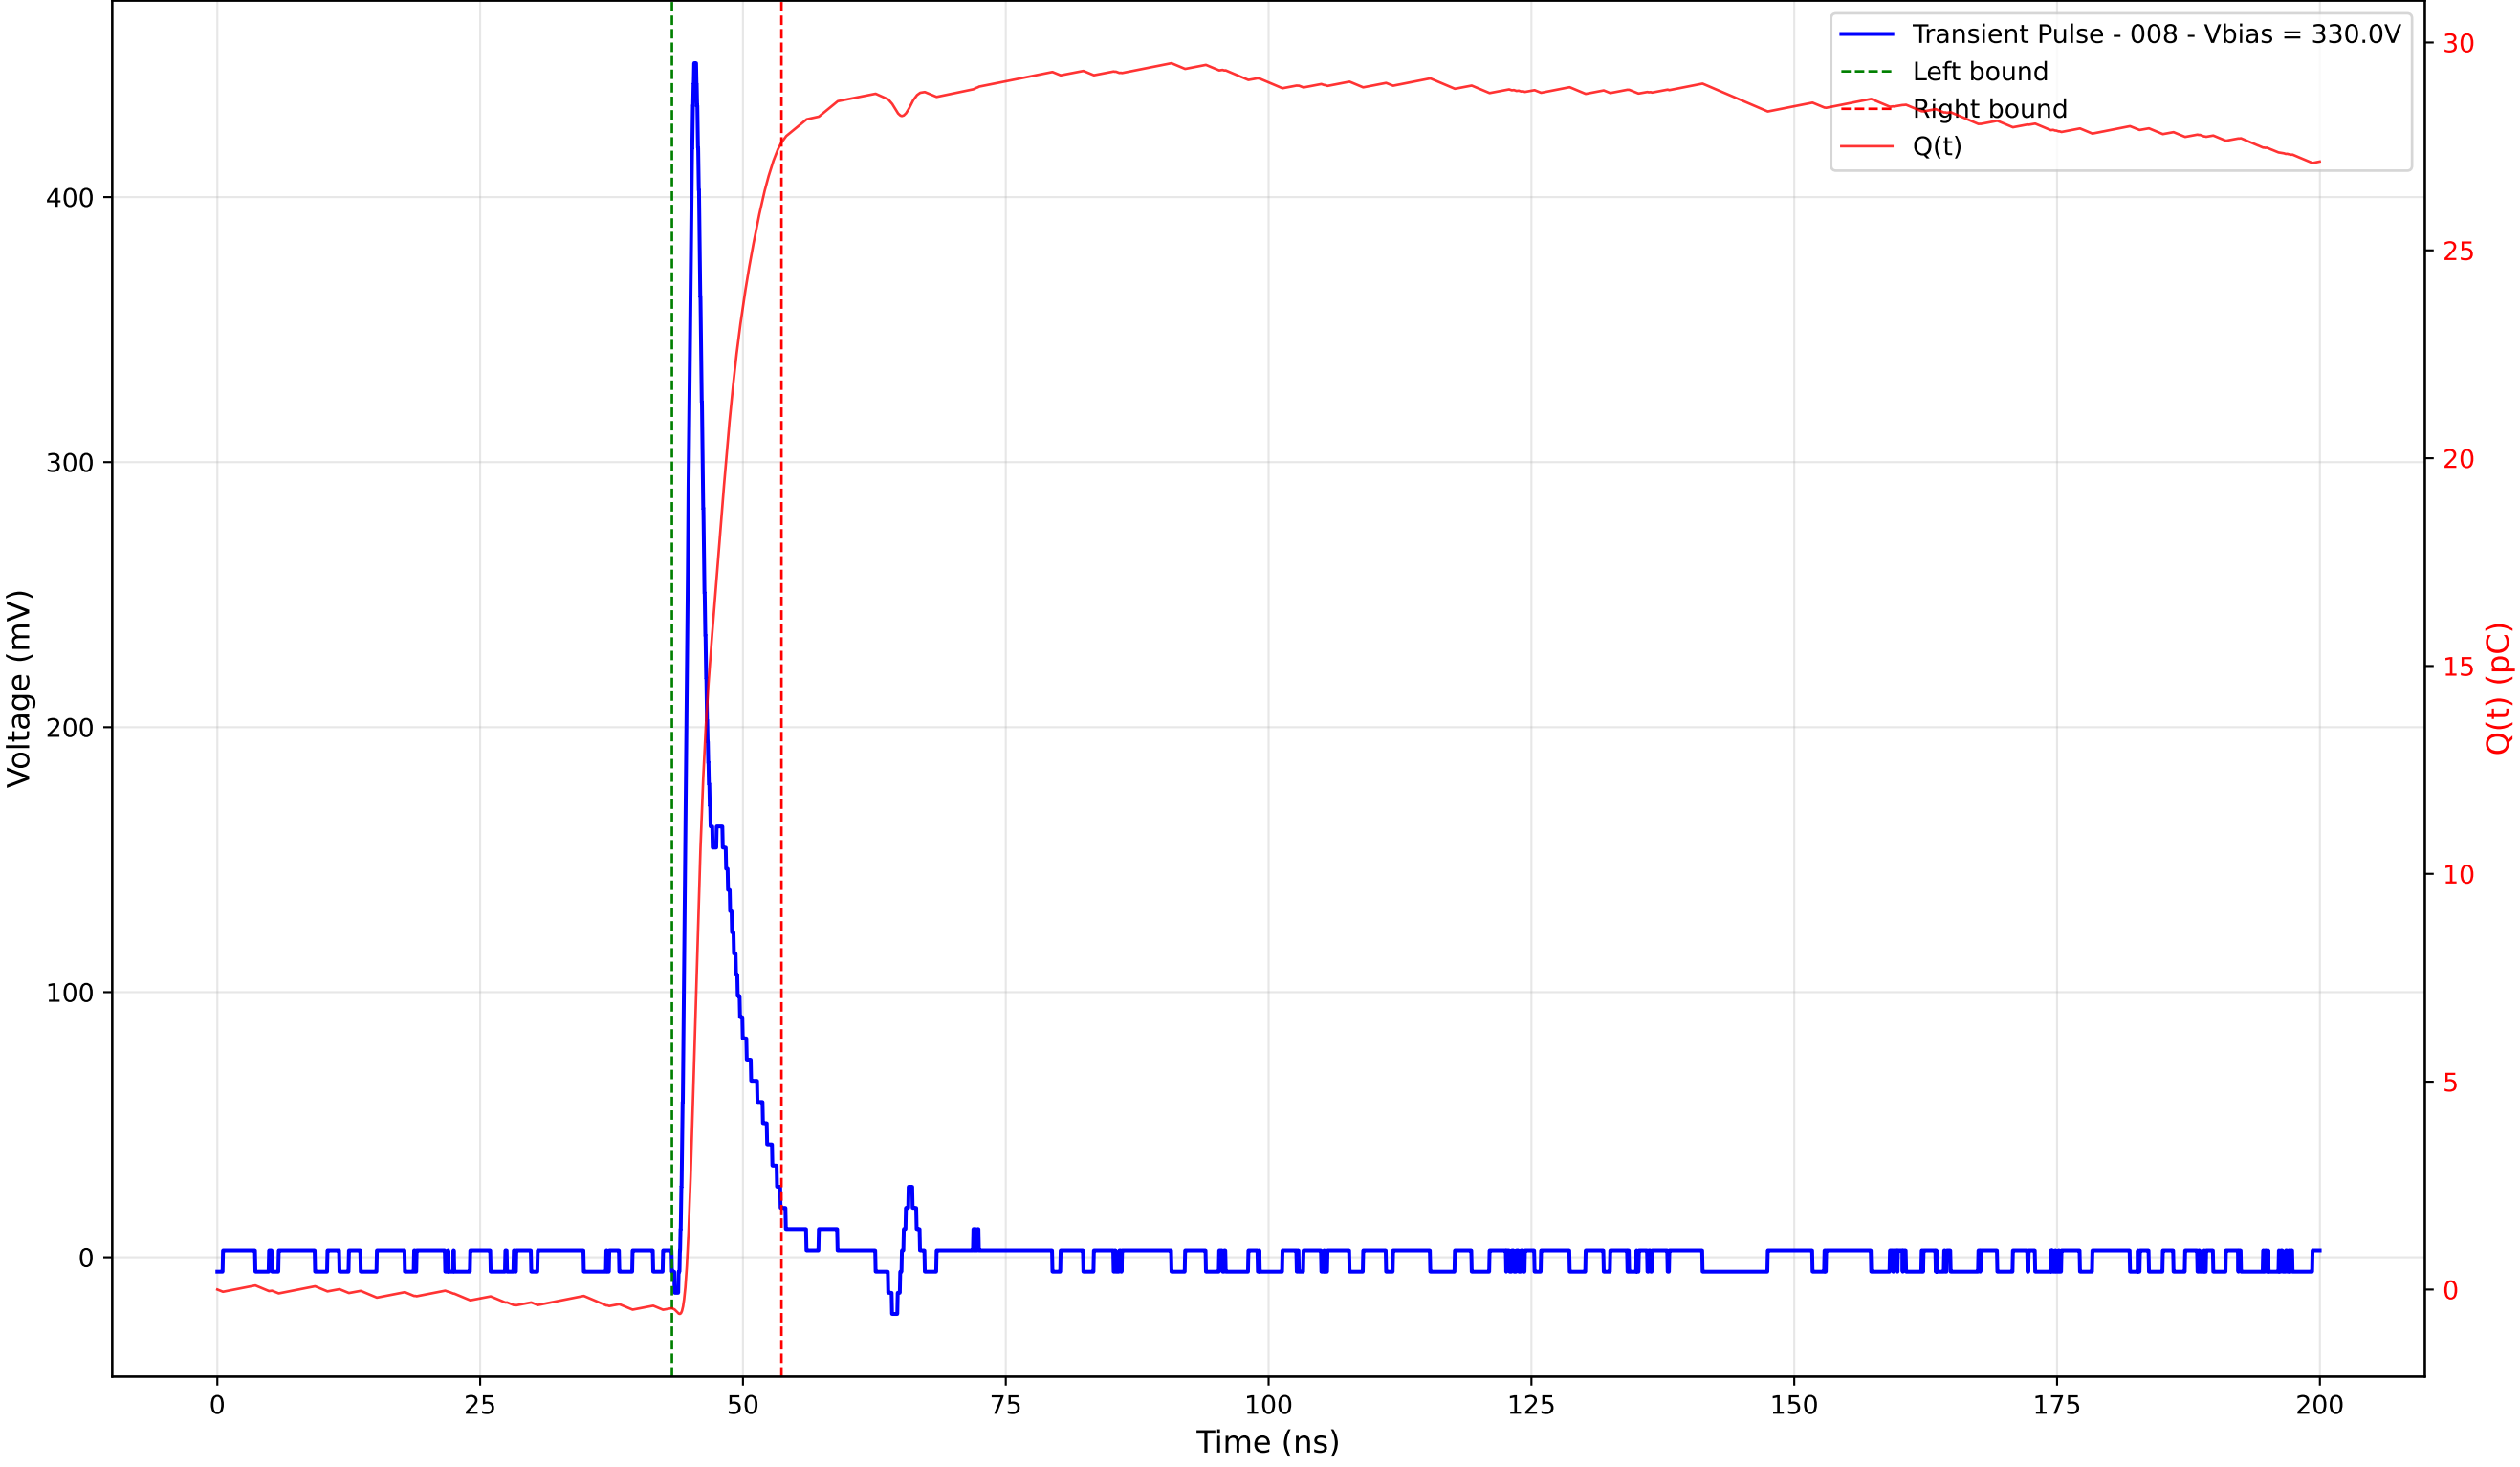


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 32.53 pC - Rise Time: 0.89 ns

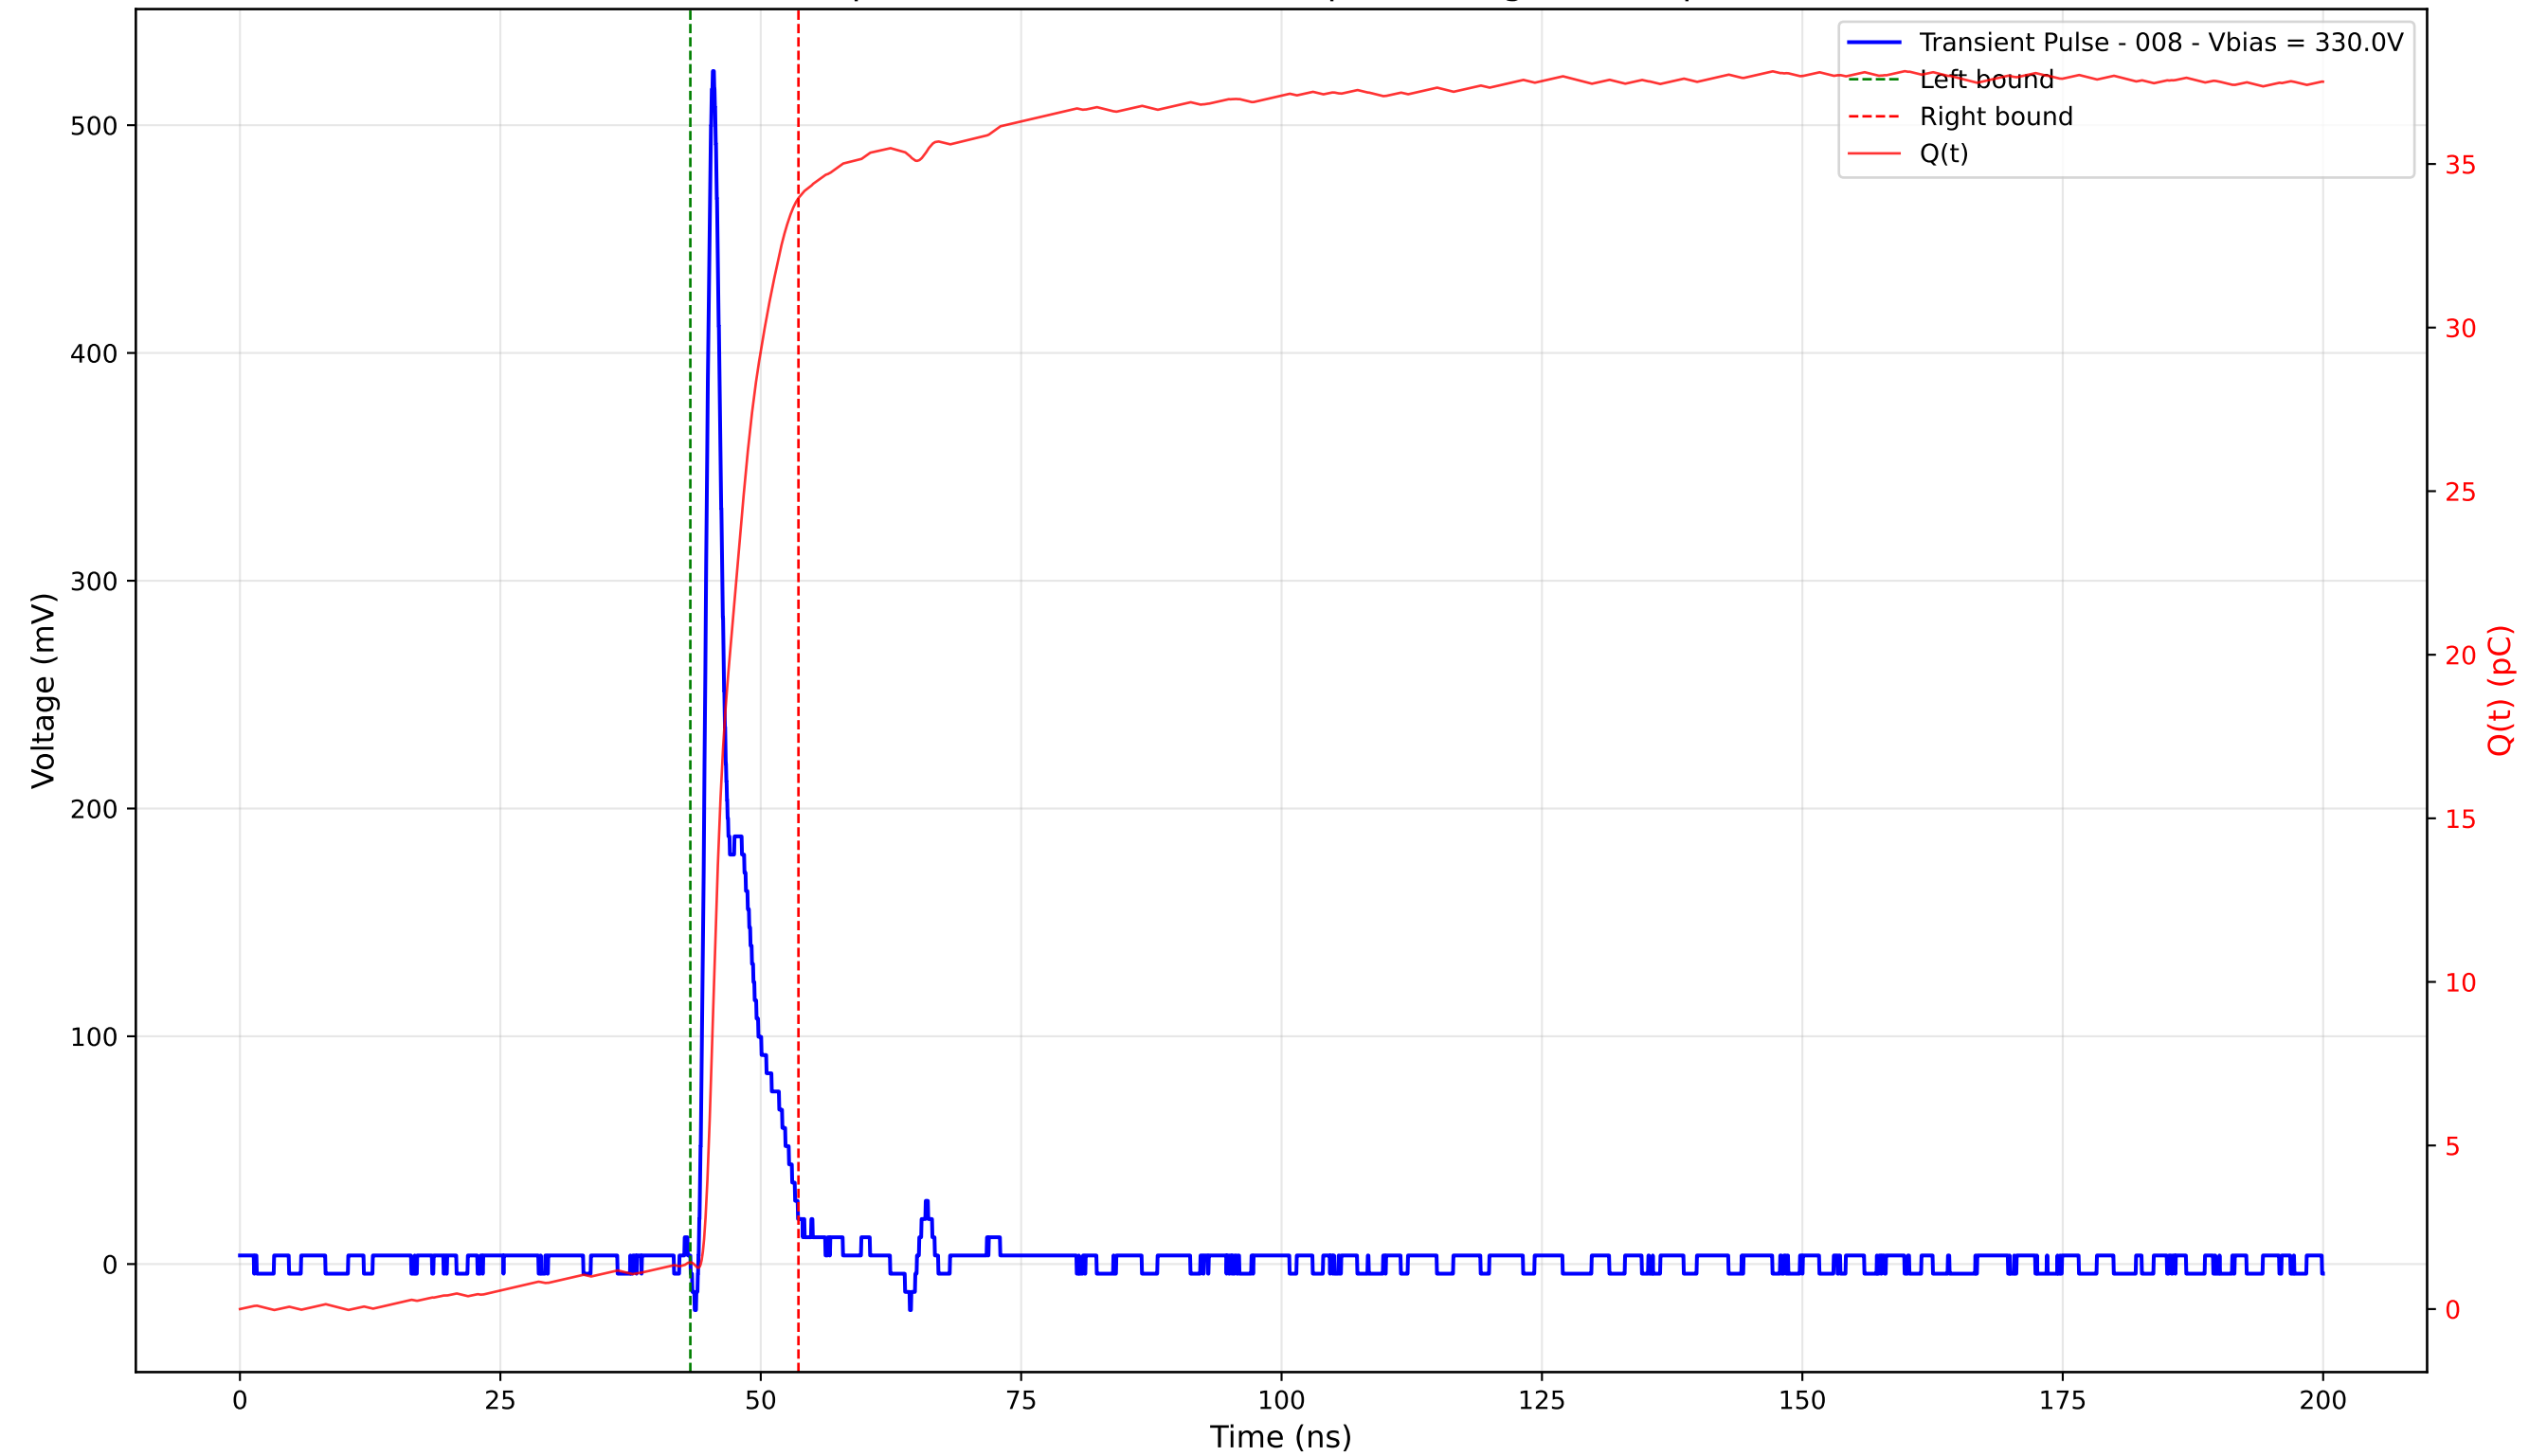


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 34.36 pC - Rise Time: 0.88 ns

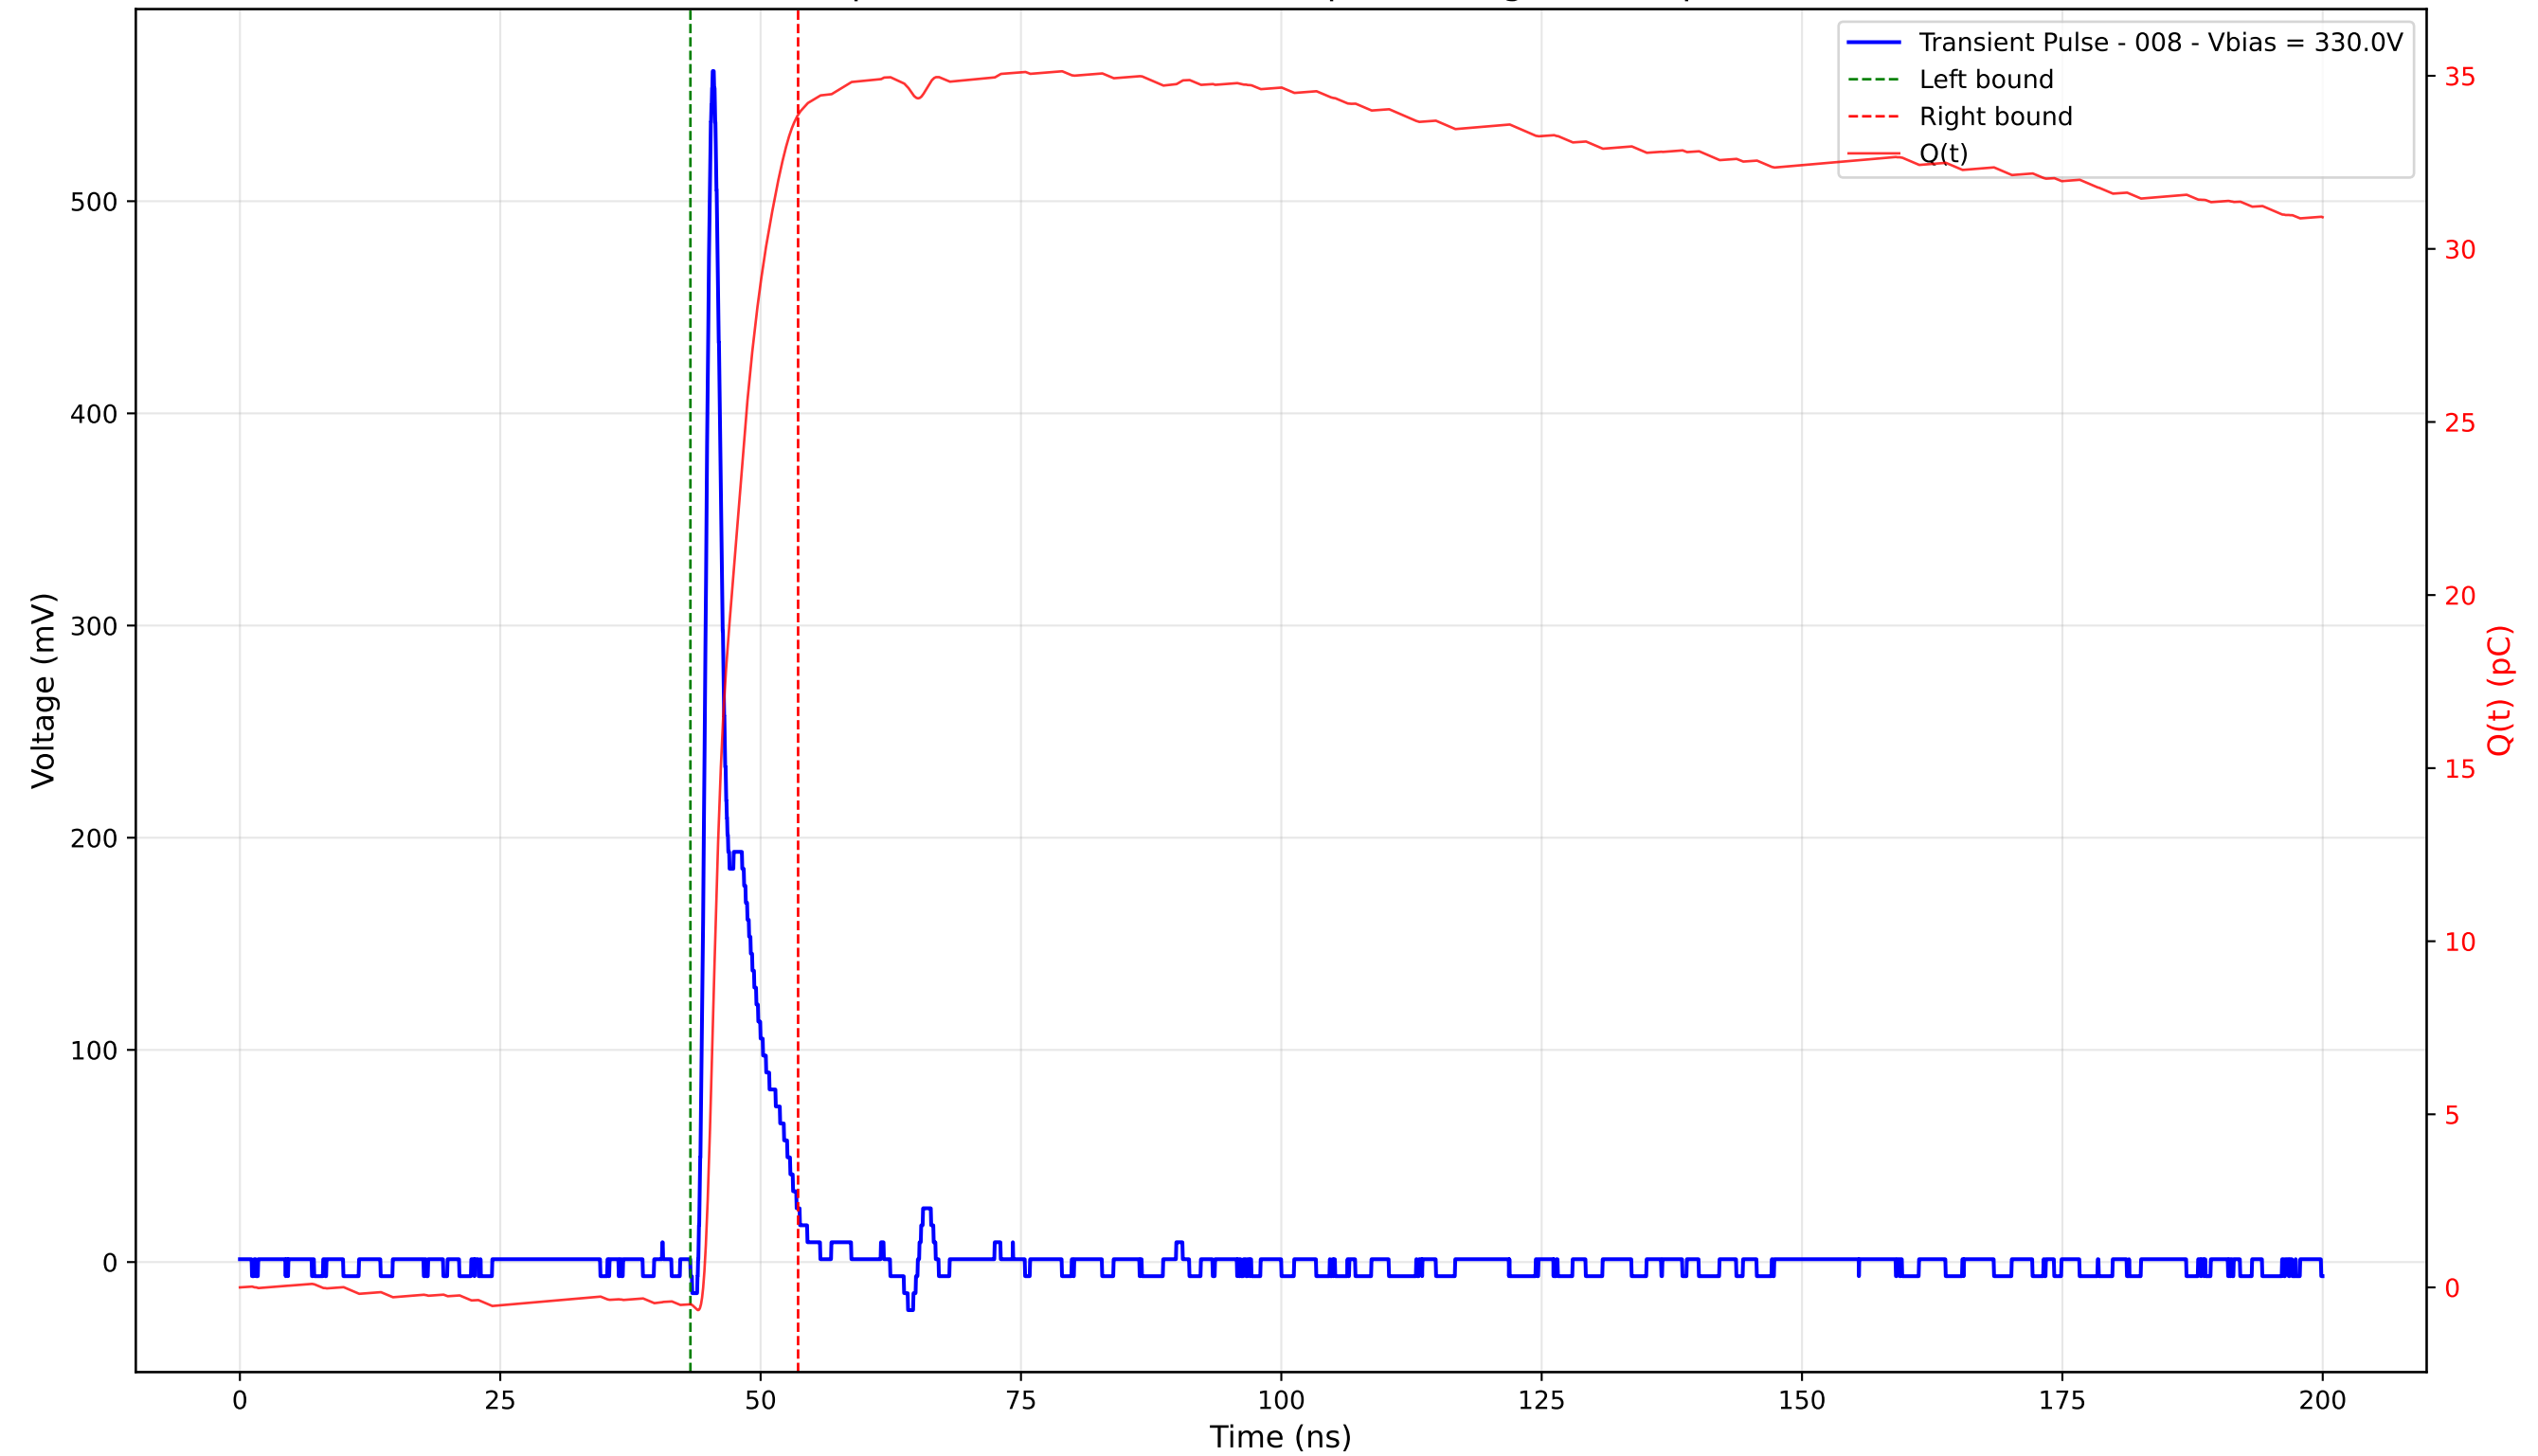


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 36.38 pC - Rise Time: 0.88 ns

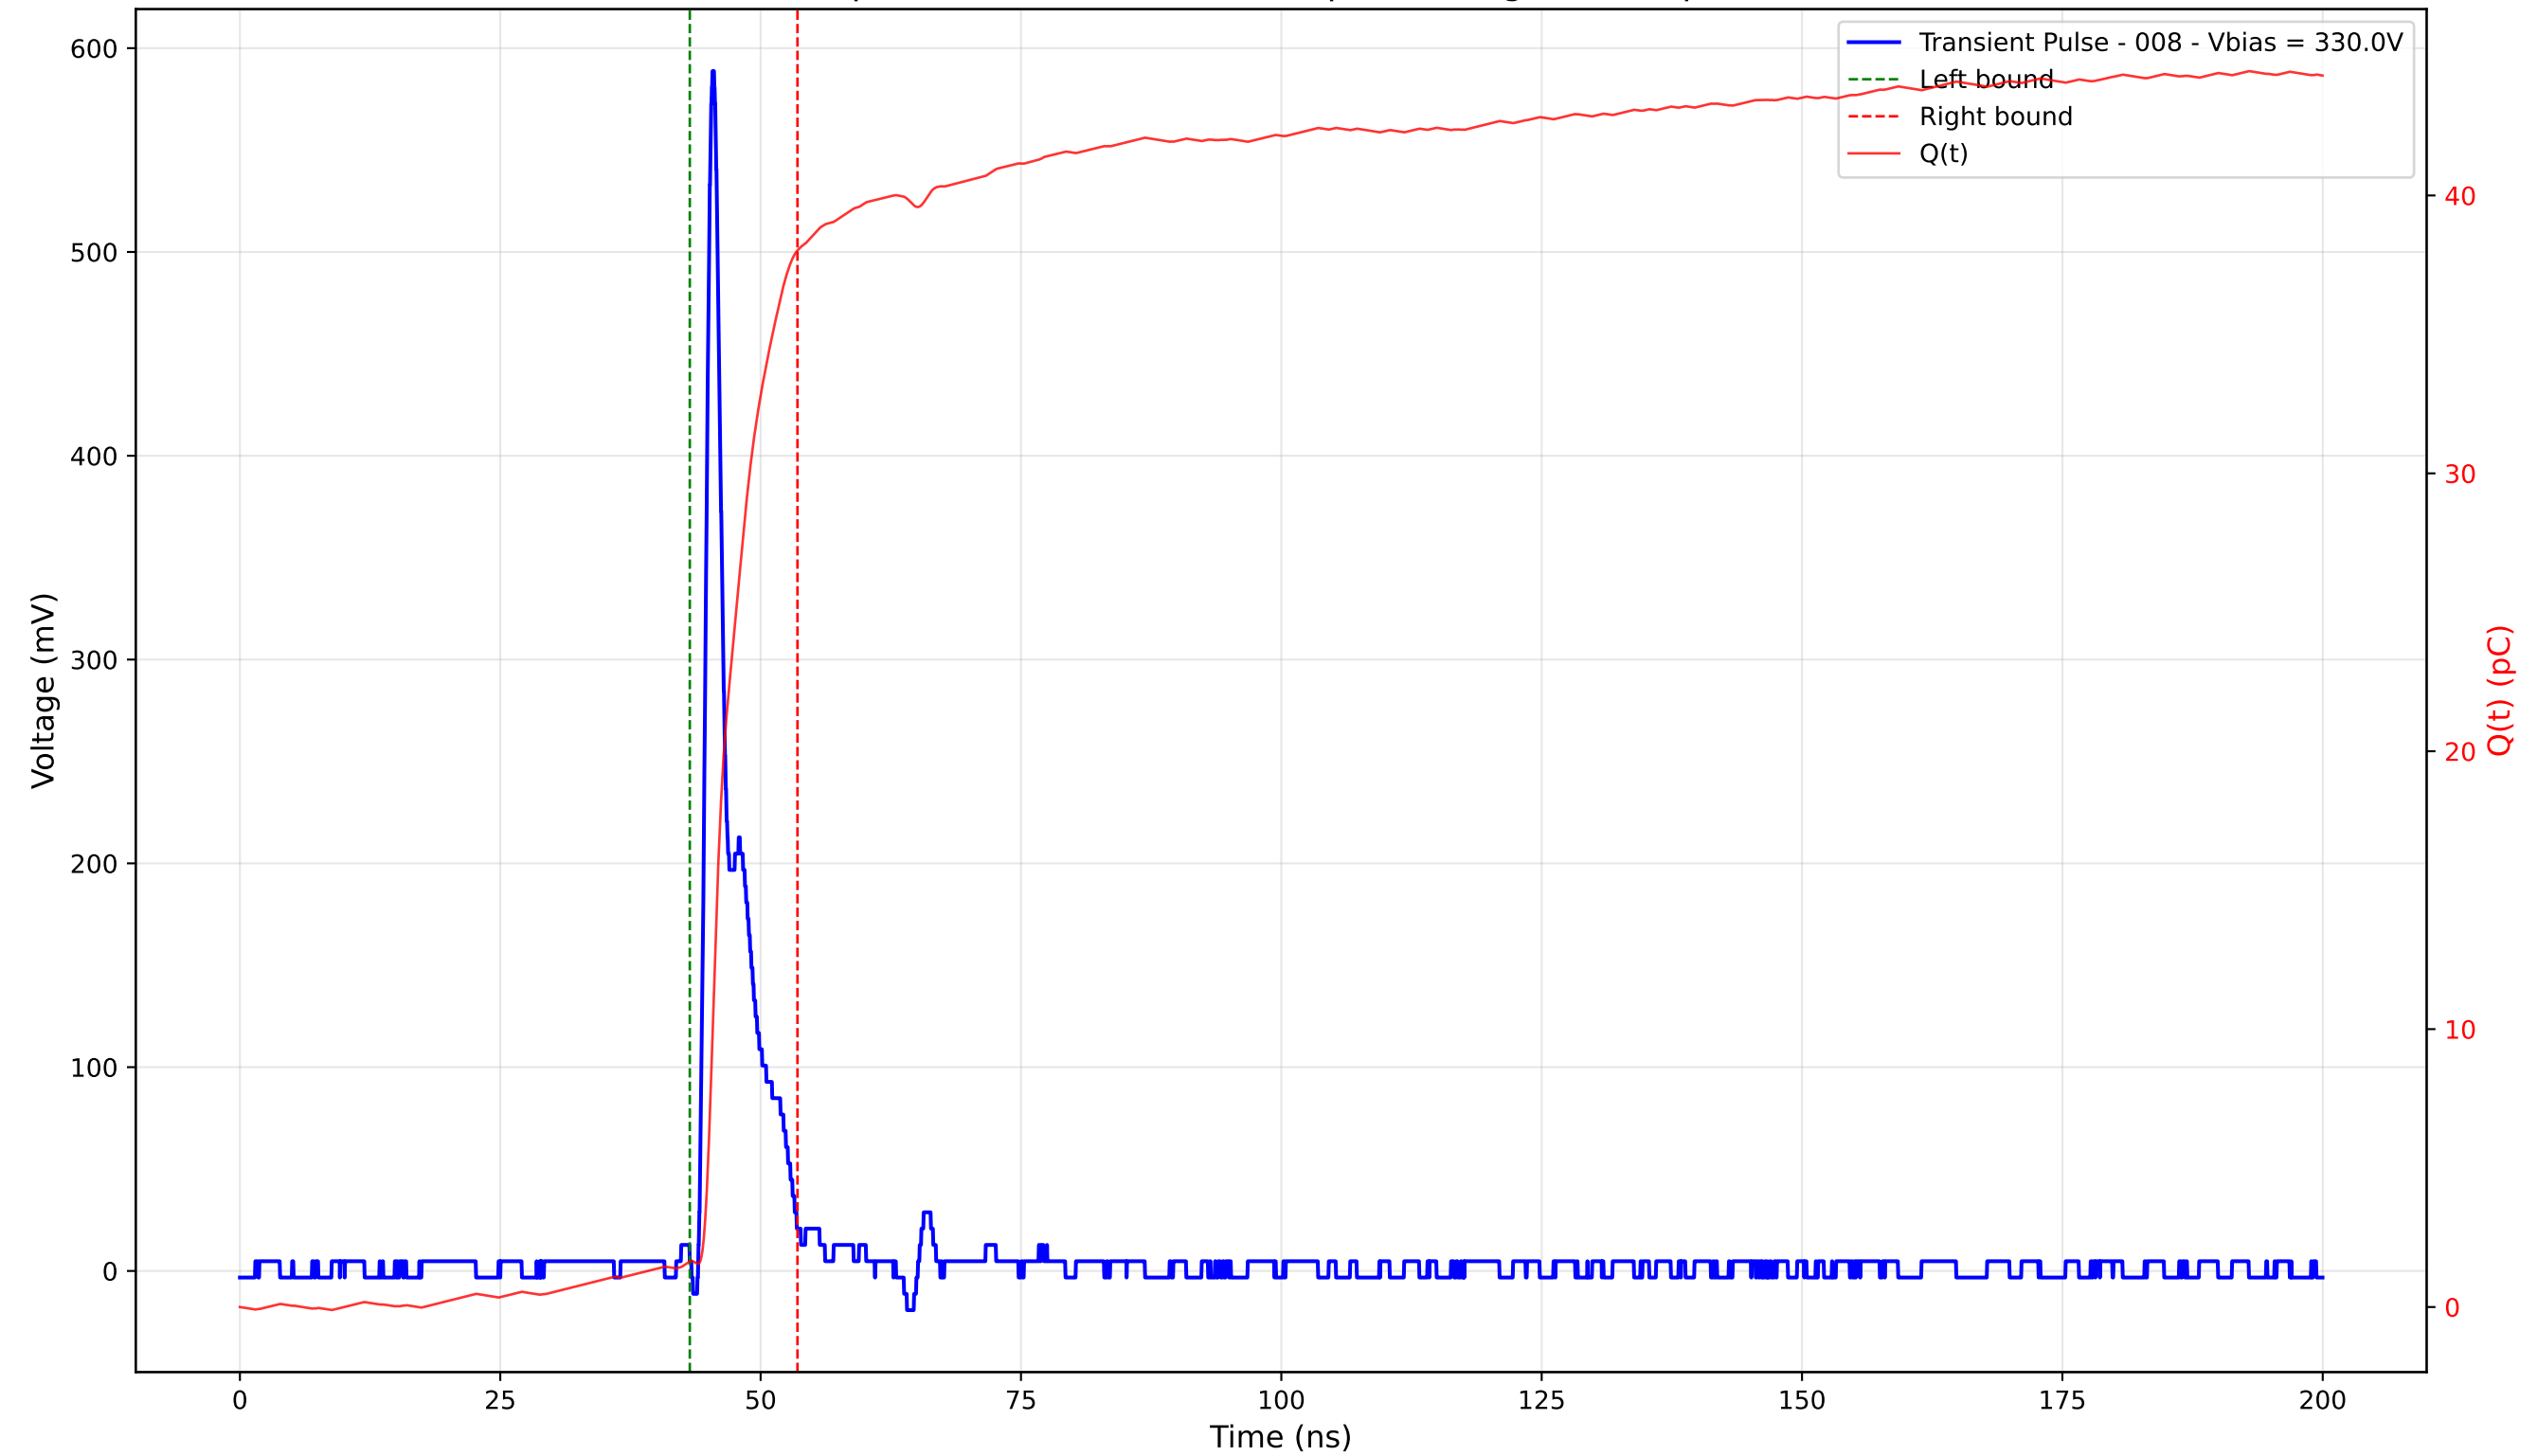


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 36.46 pC - Rise Time: 0.90 ns

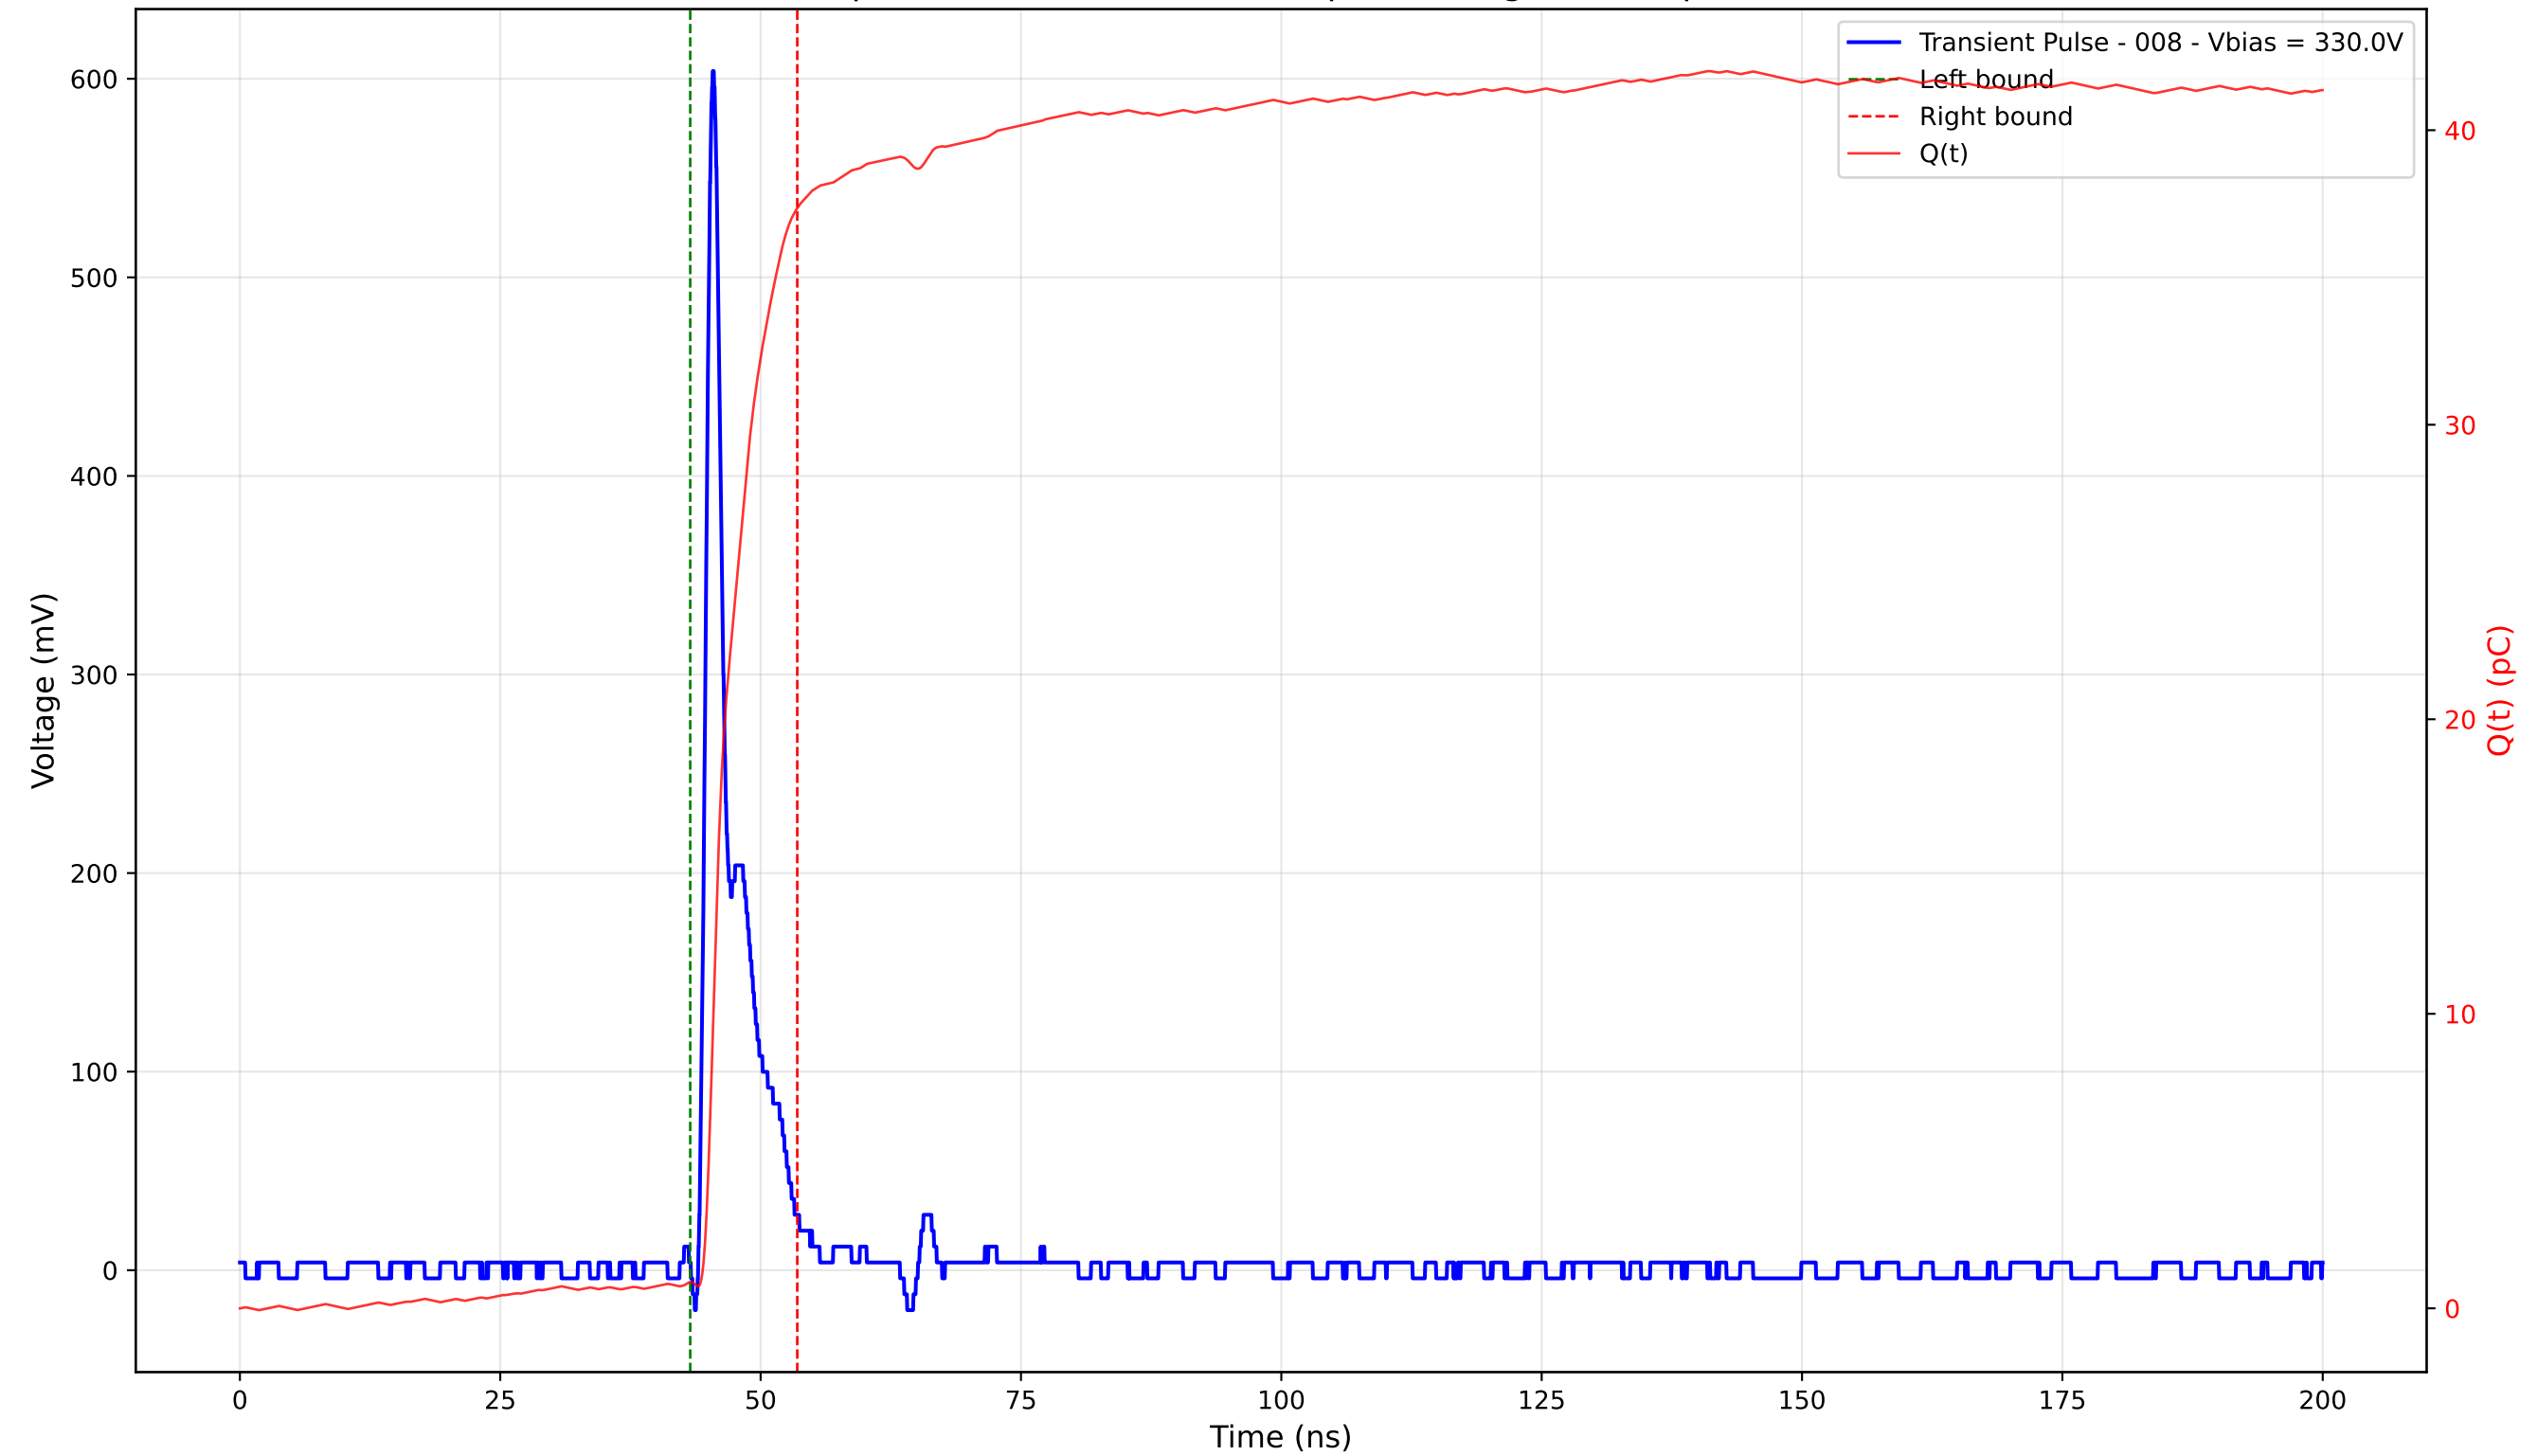


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 35.96 pC - Rise Time: 0.90 ns

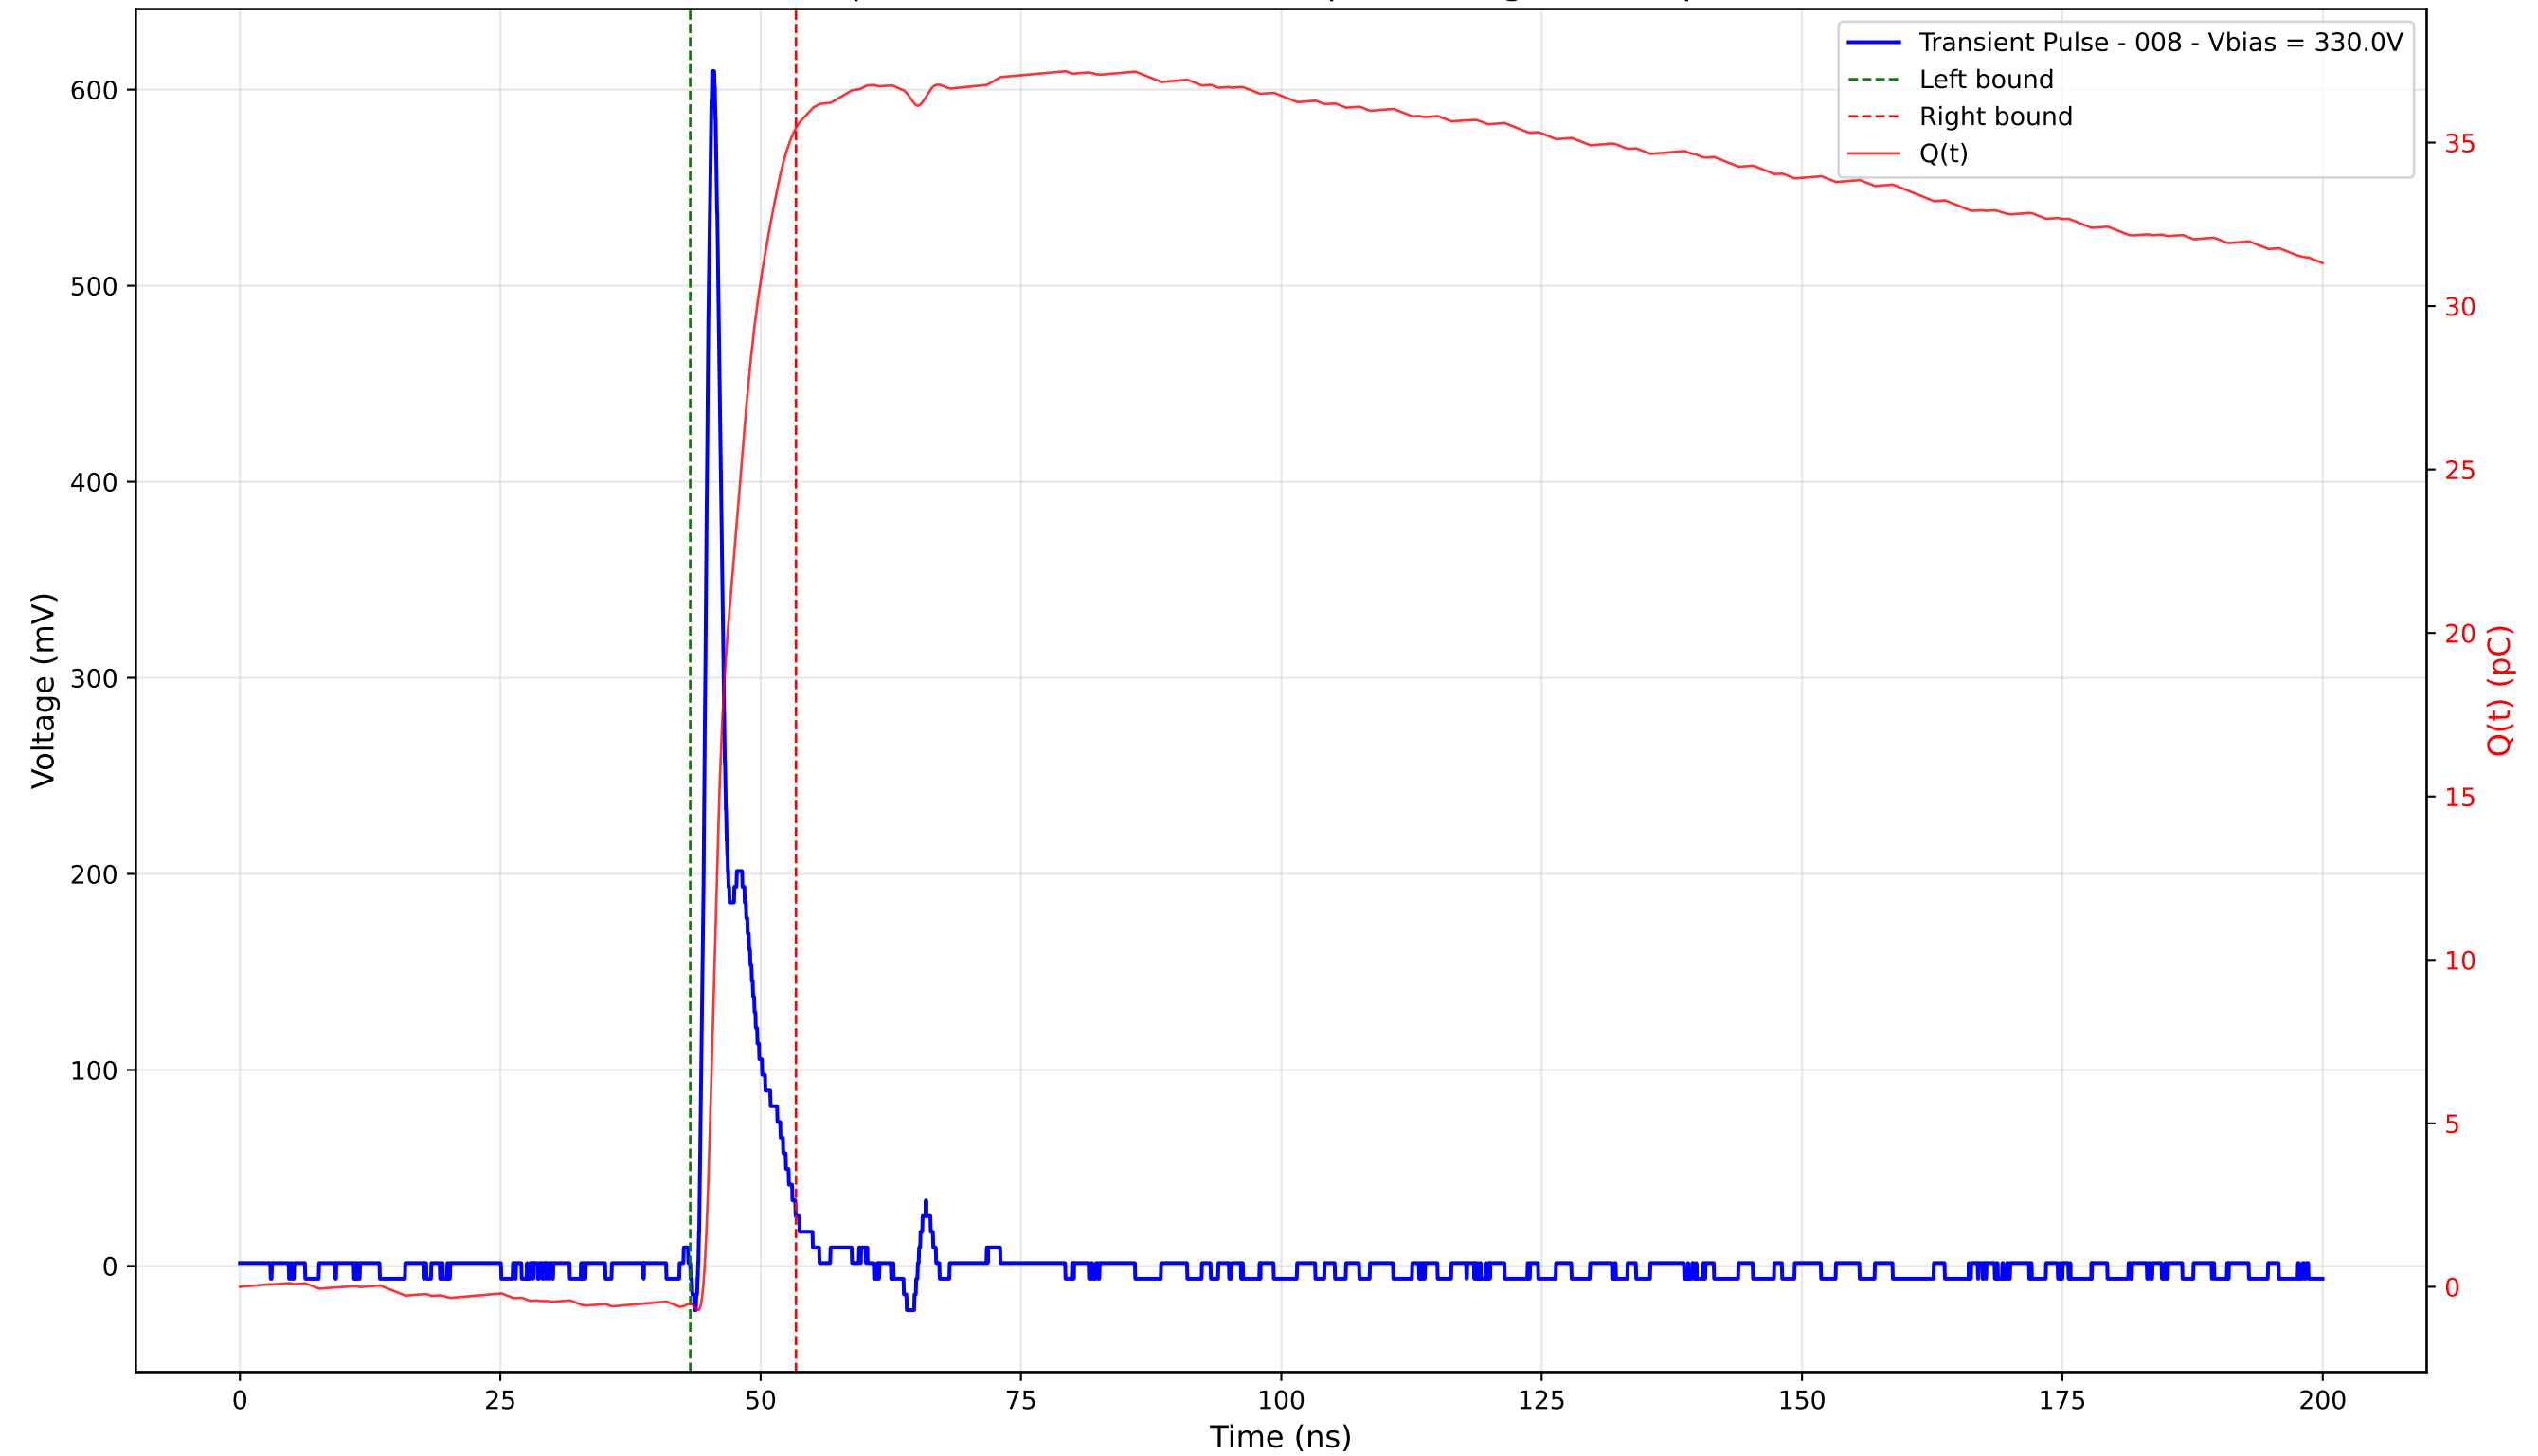


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 36.52 pC - Rise Time: 0.90 ns

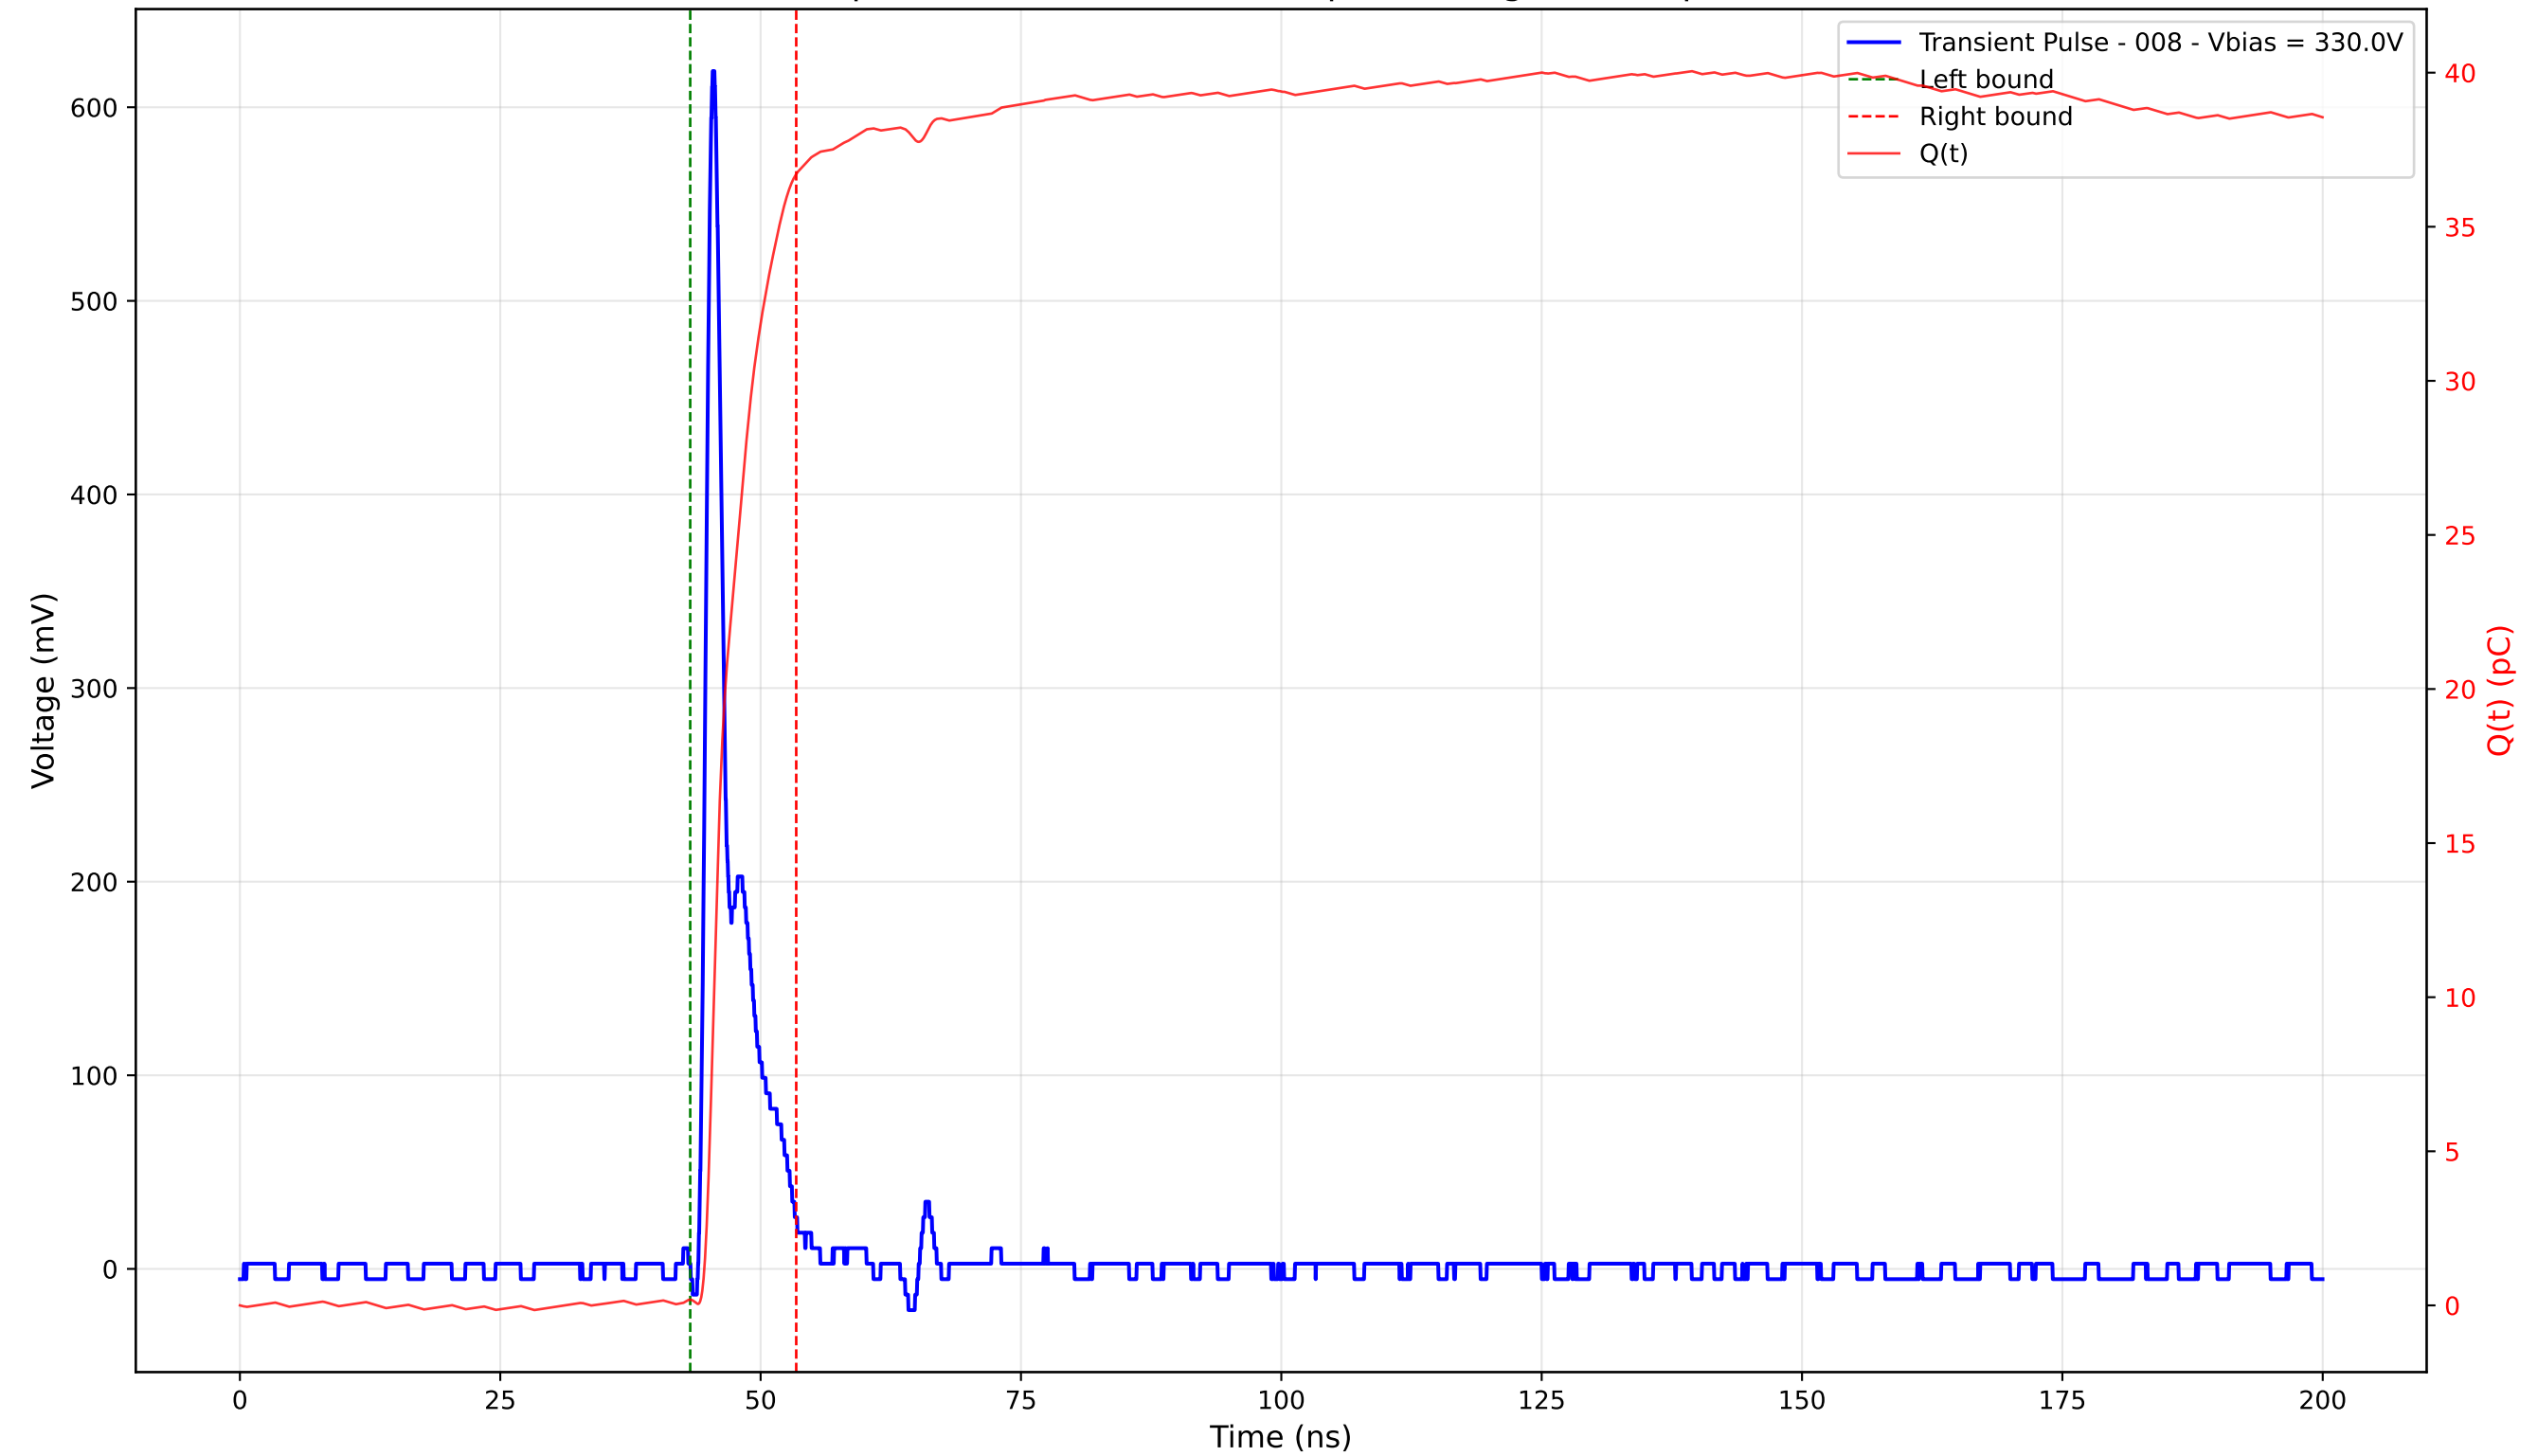


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 37.04 pC - Rise Time: 0.92 ns

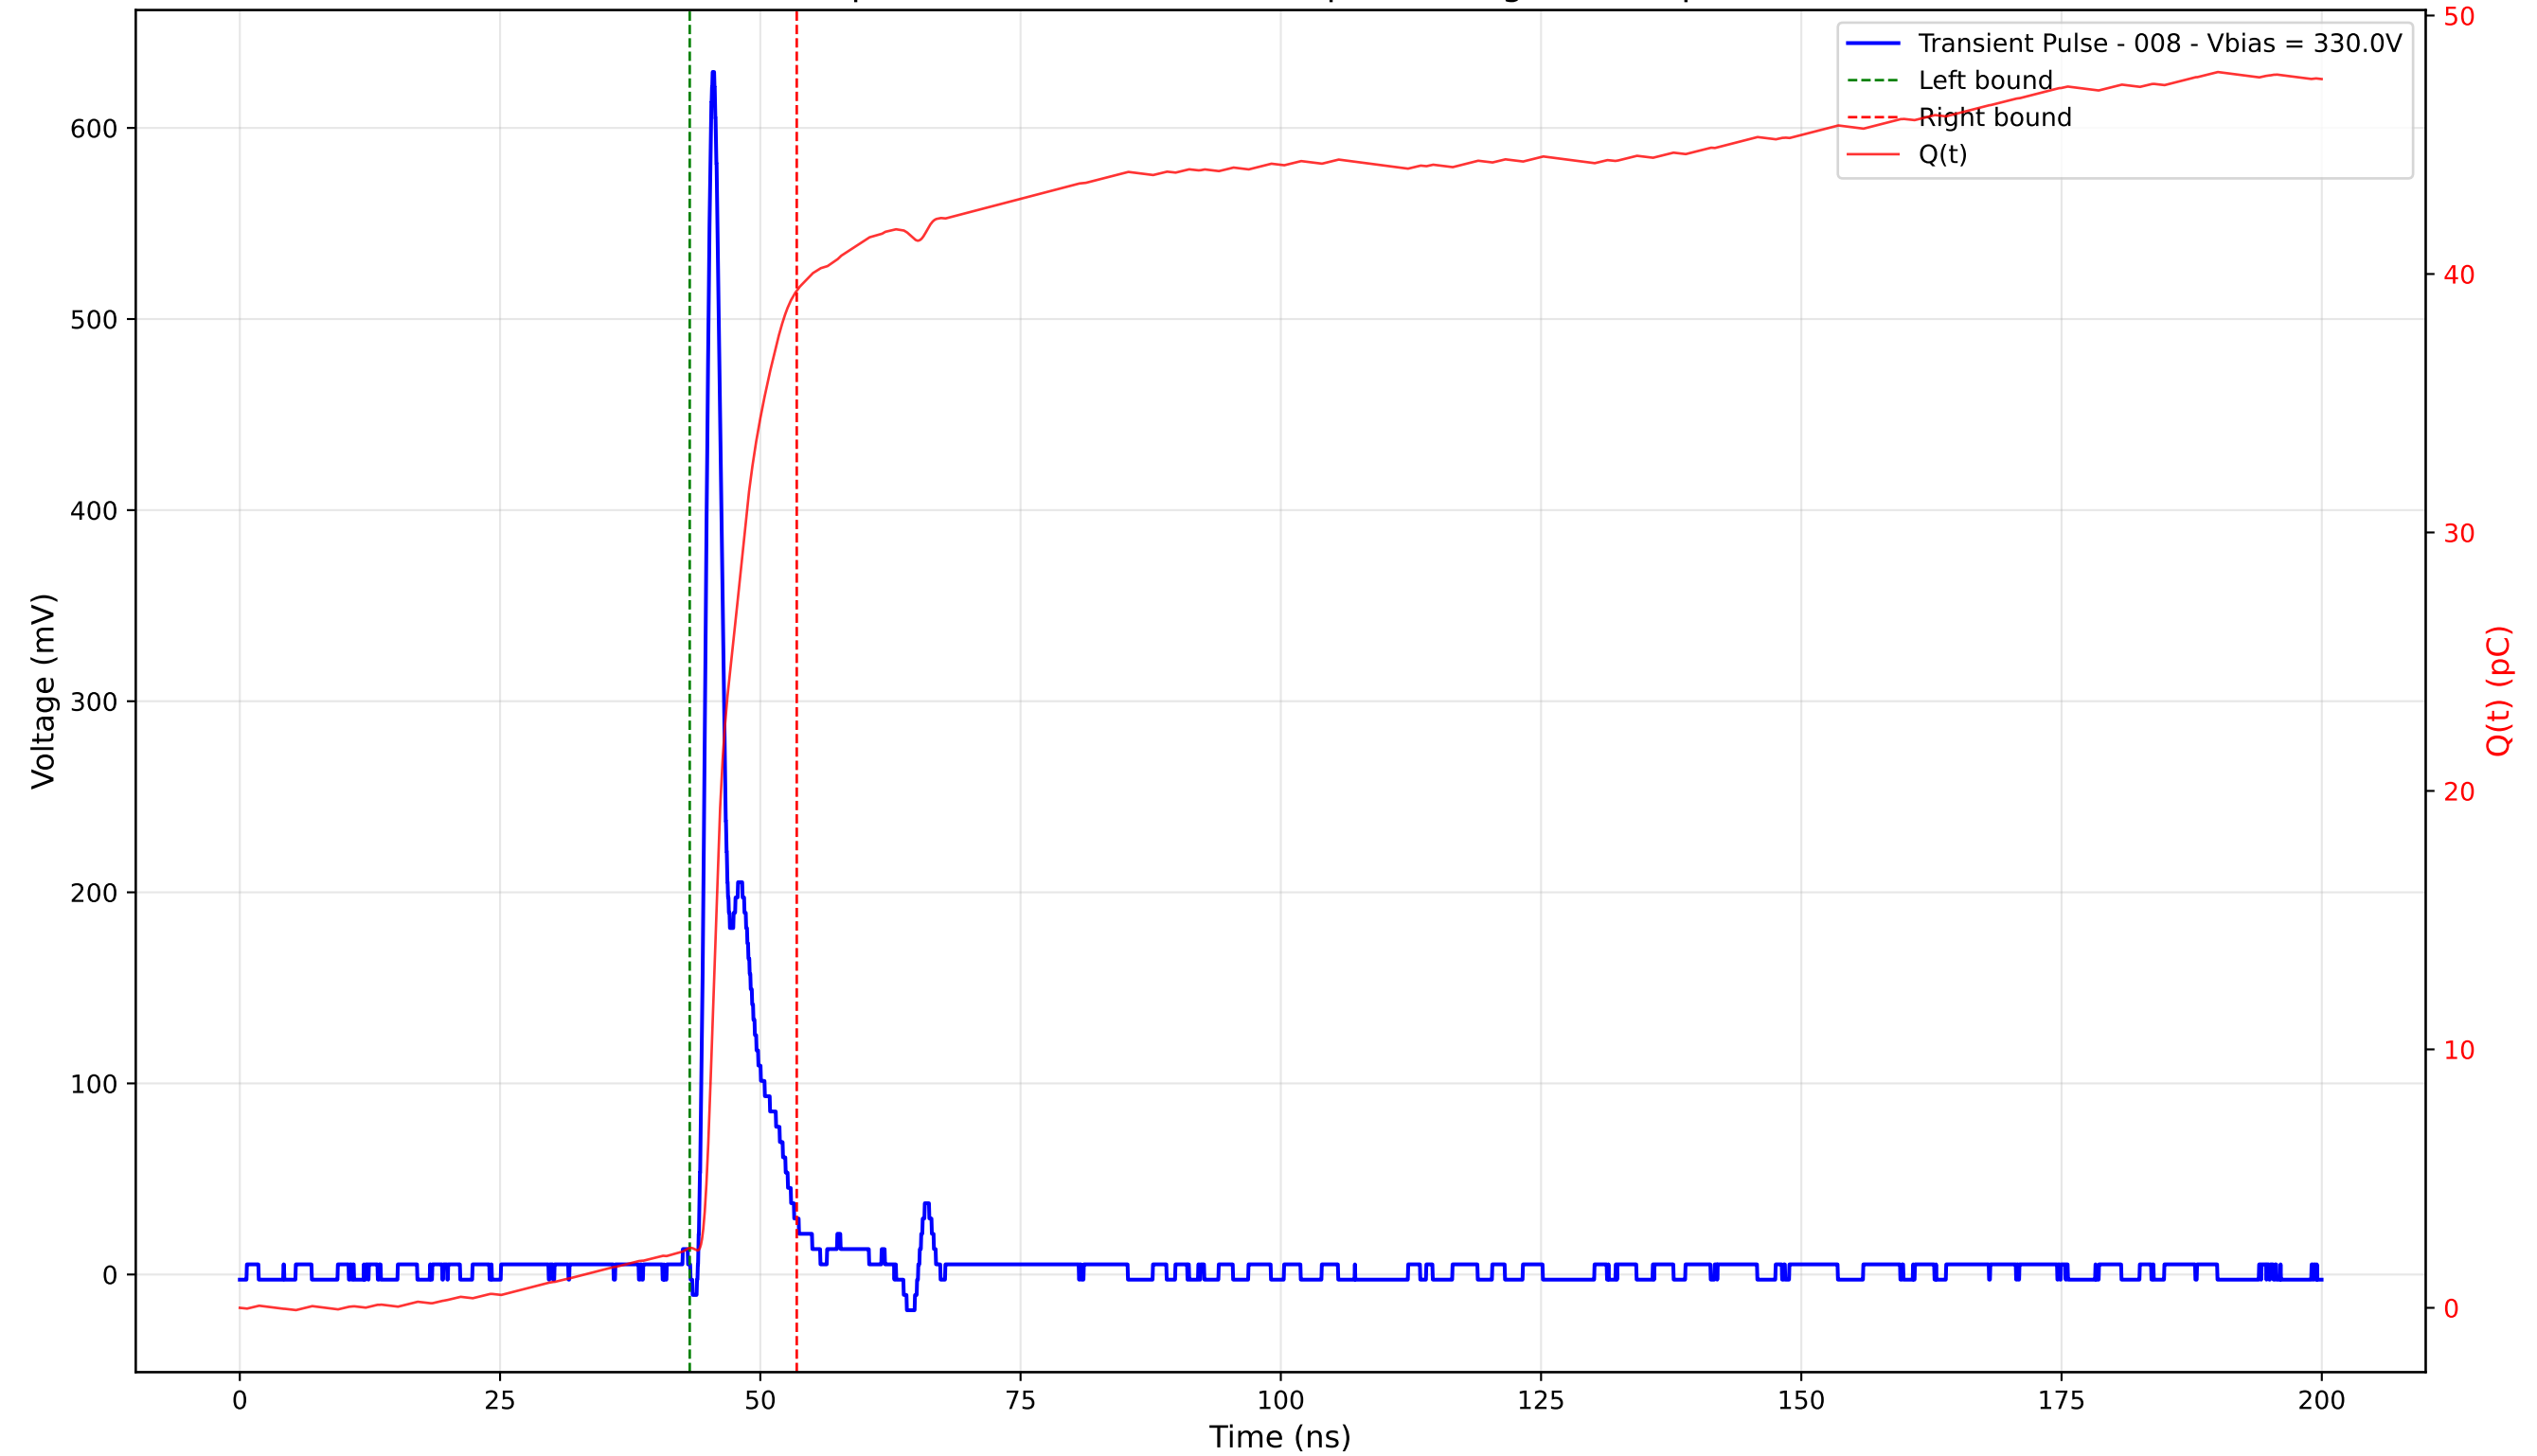


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 35.96 pC - Rise Time: 0.93 ns

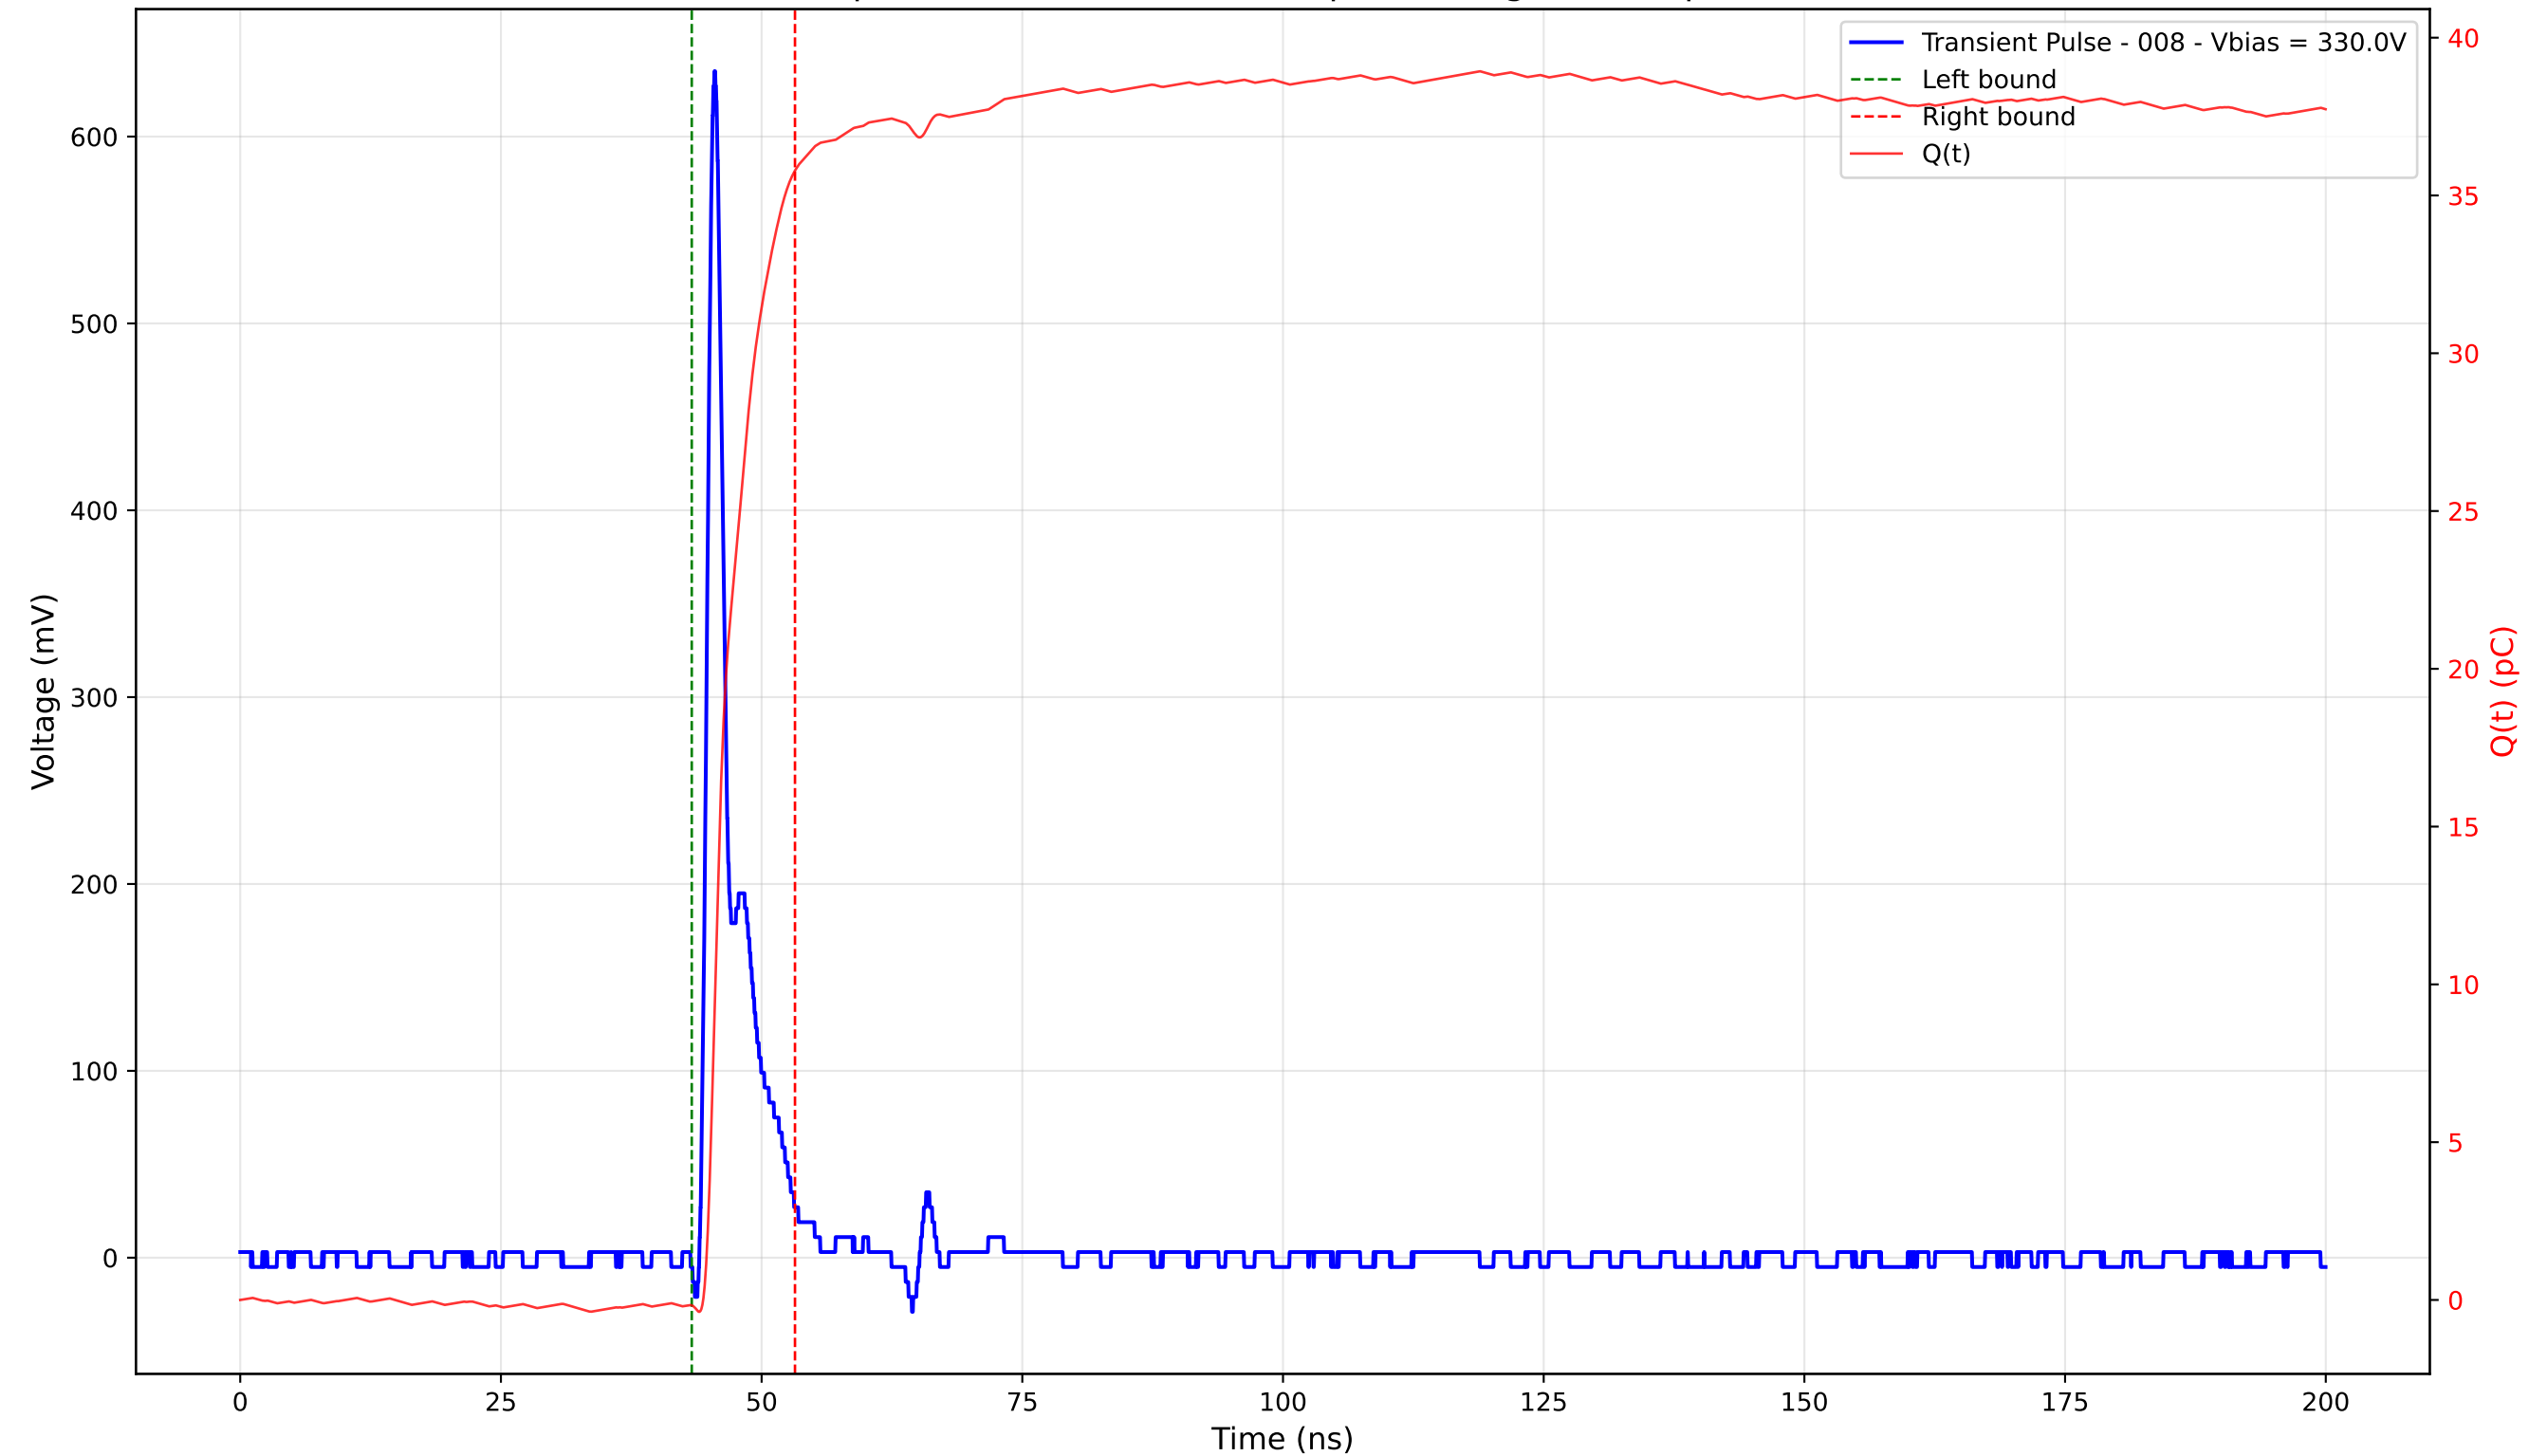


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 36.09 pC - Rise Time: 0.95 ns

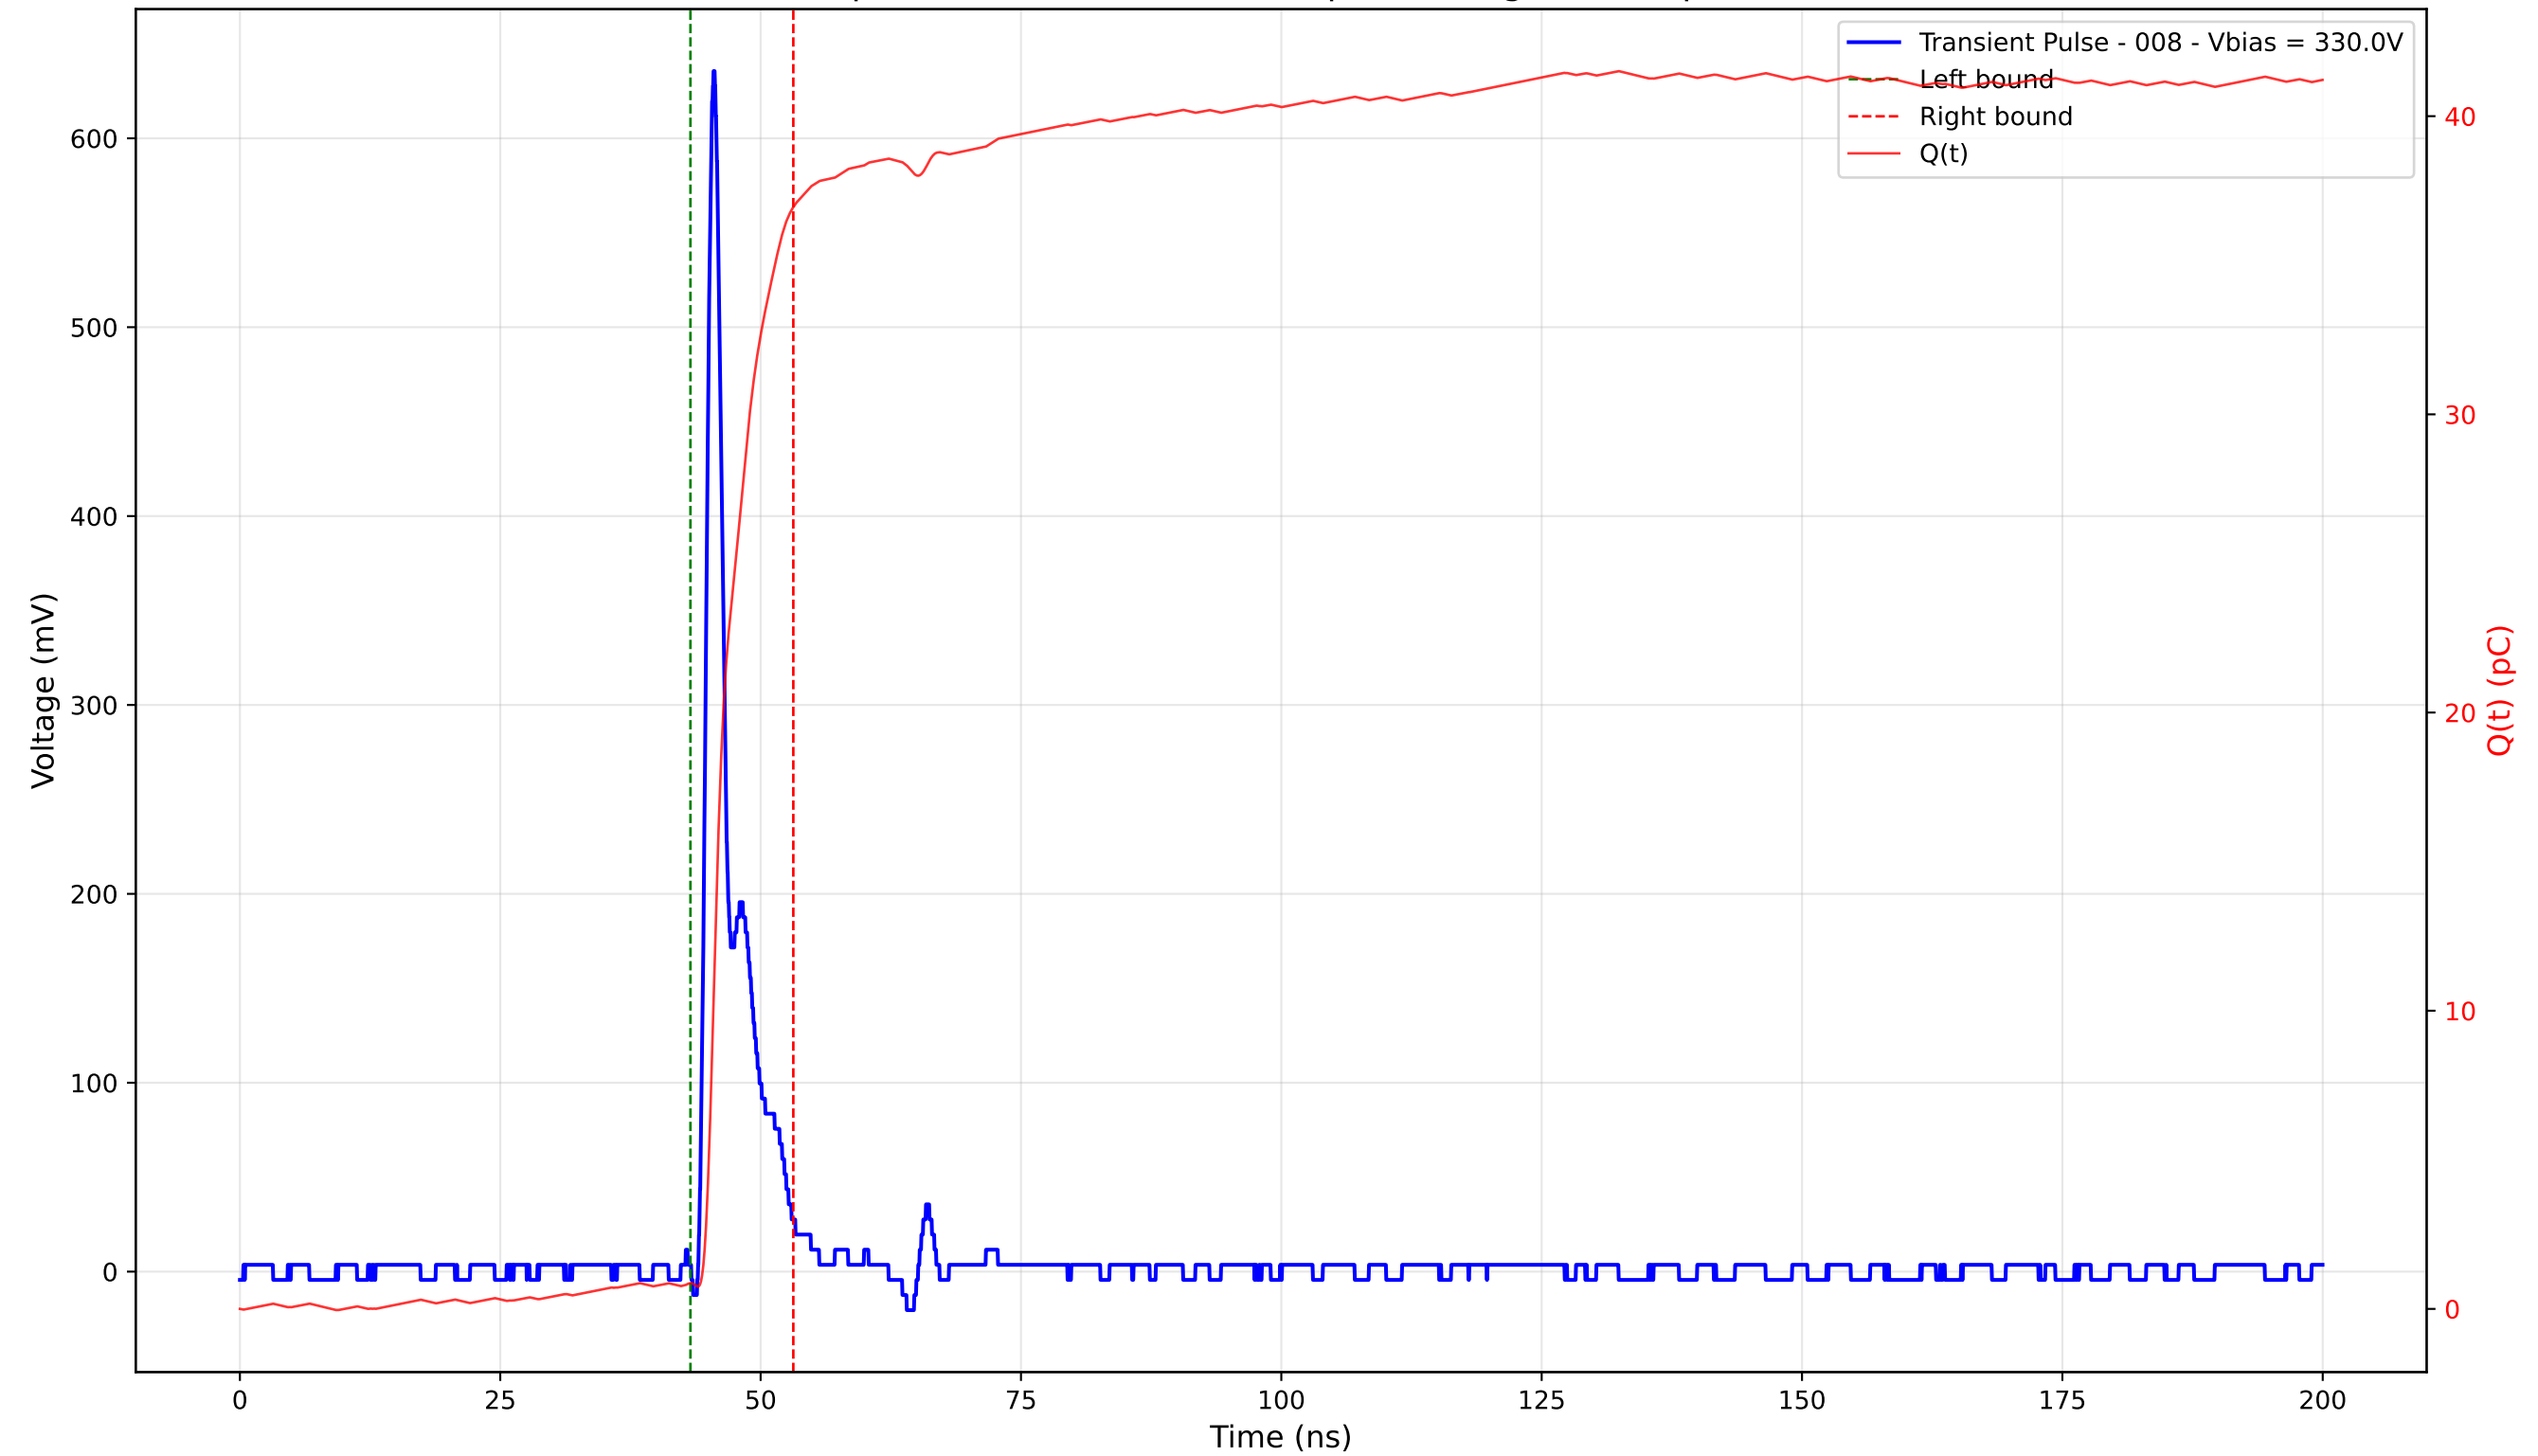


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 35.72 pC - Rise Time: 0.92 ns

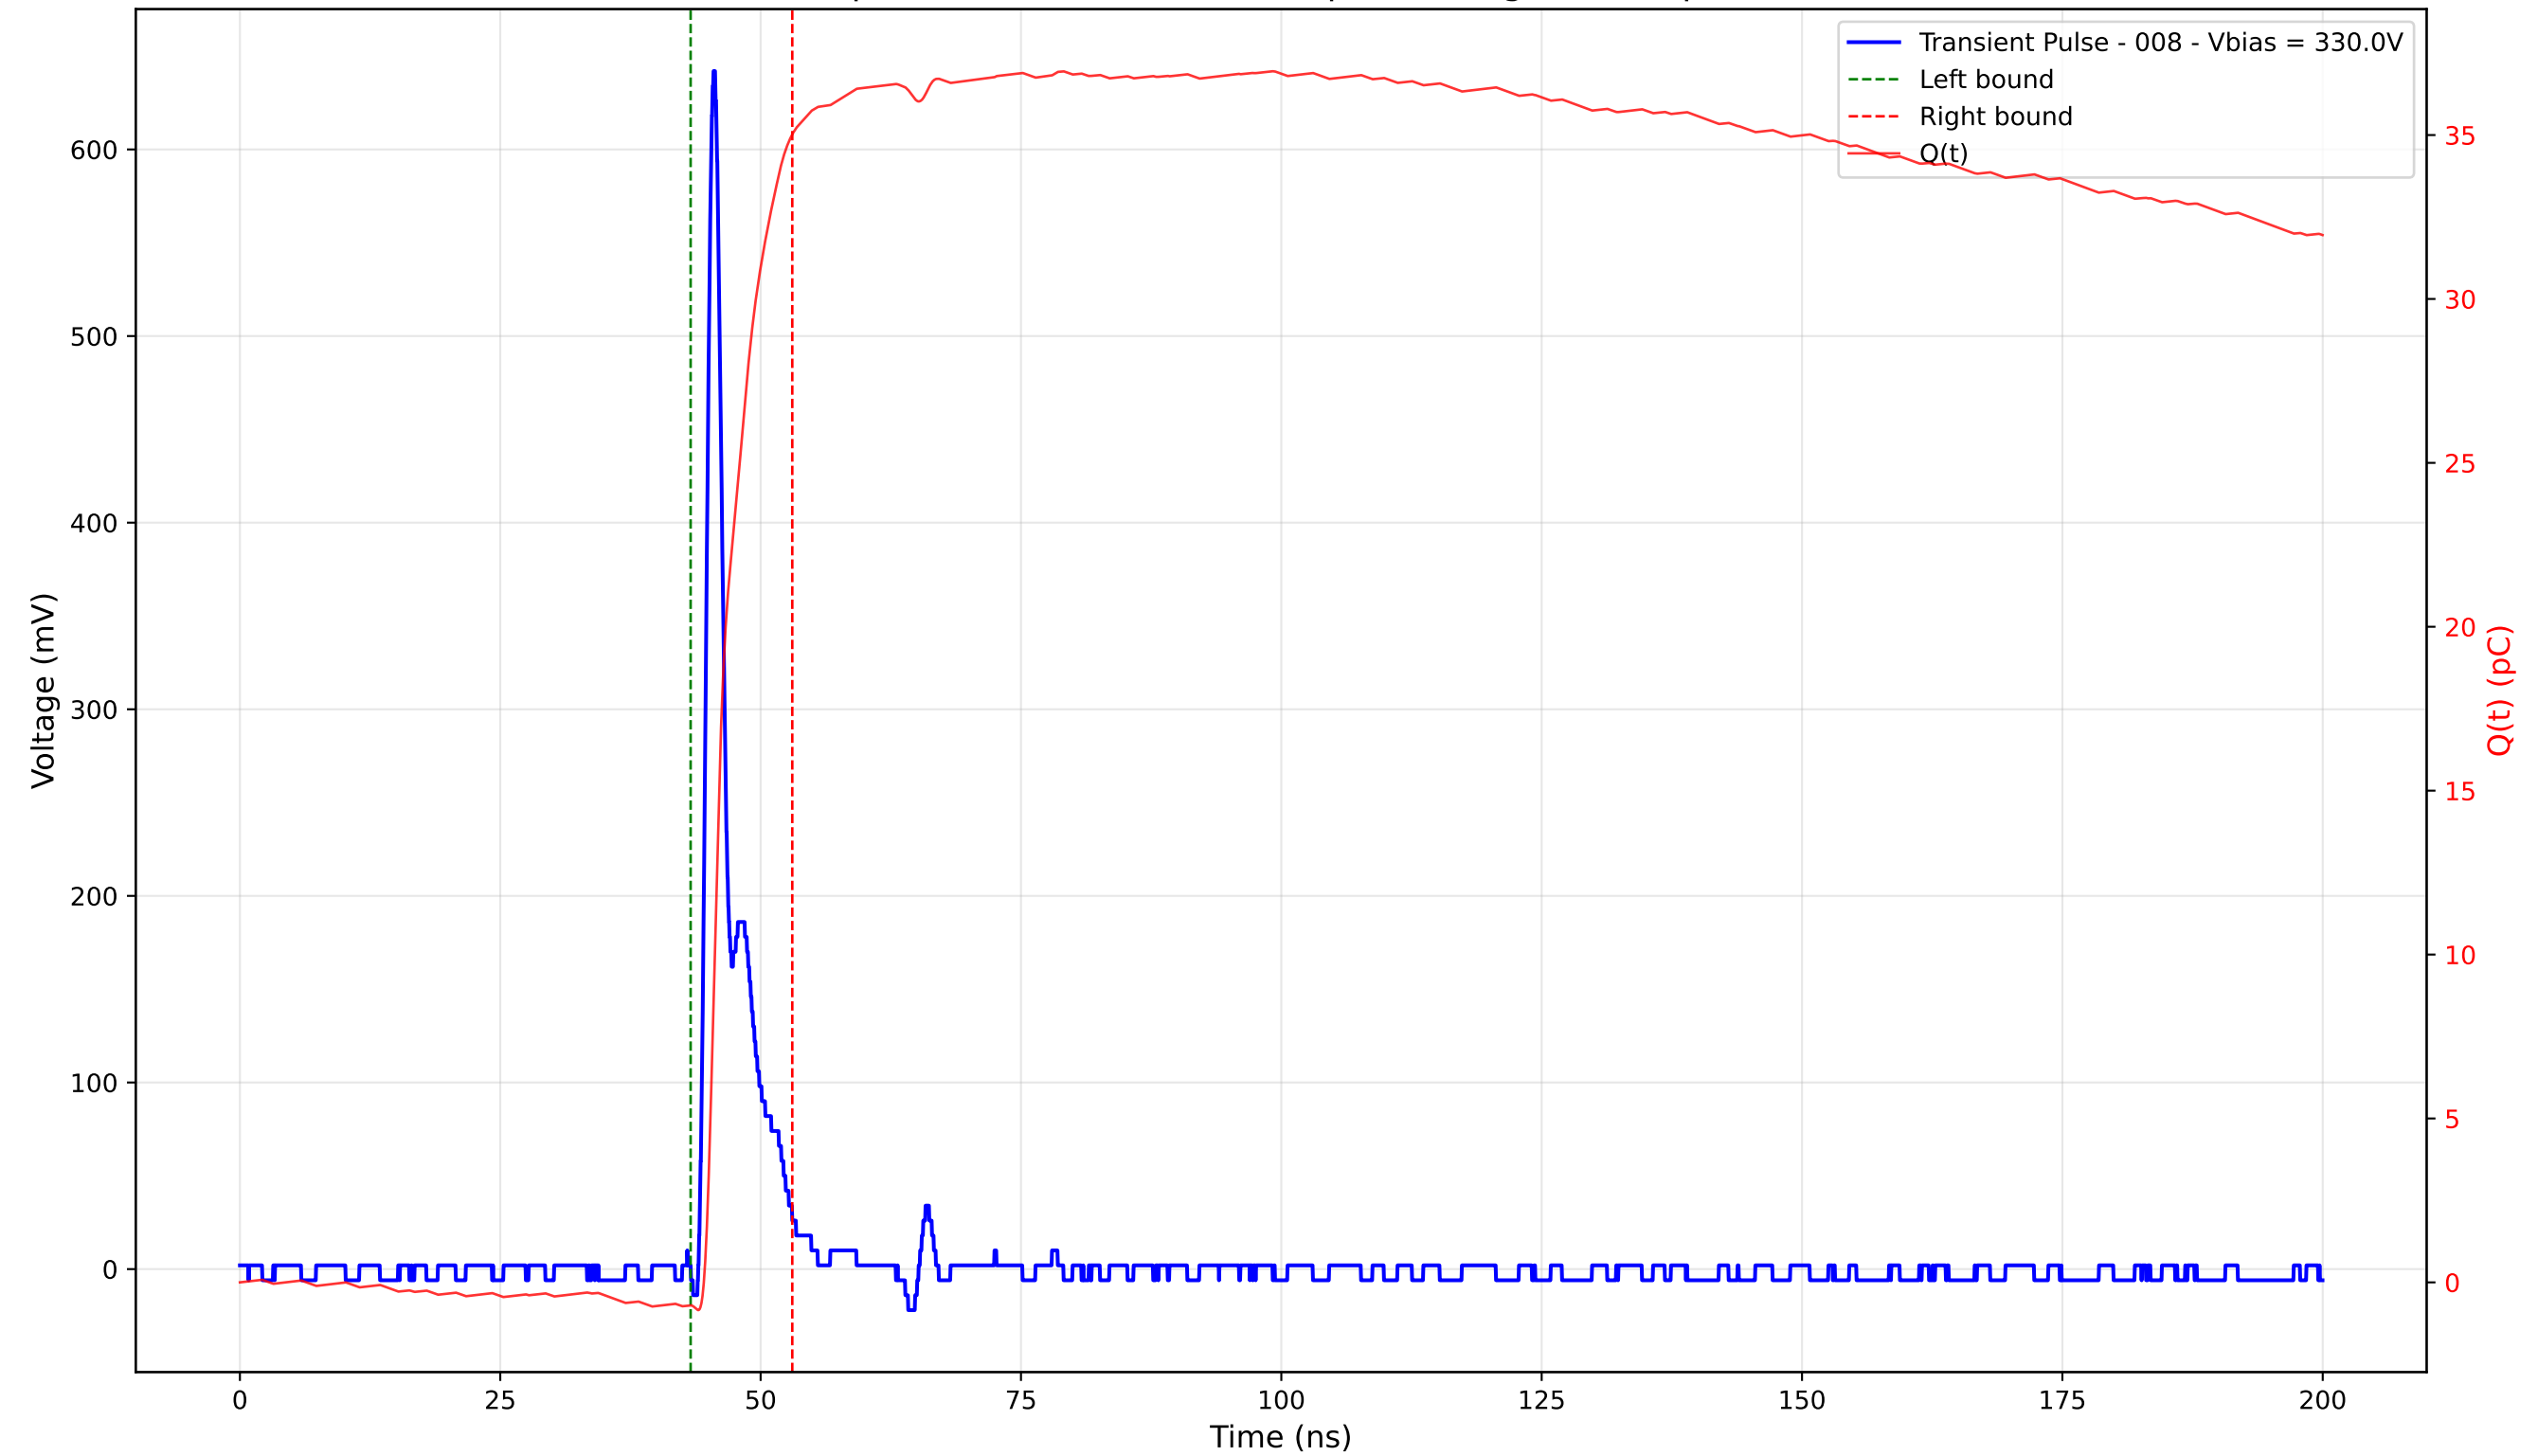


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 36.01 pC - Rise Time: 0.94 ns

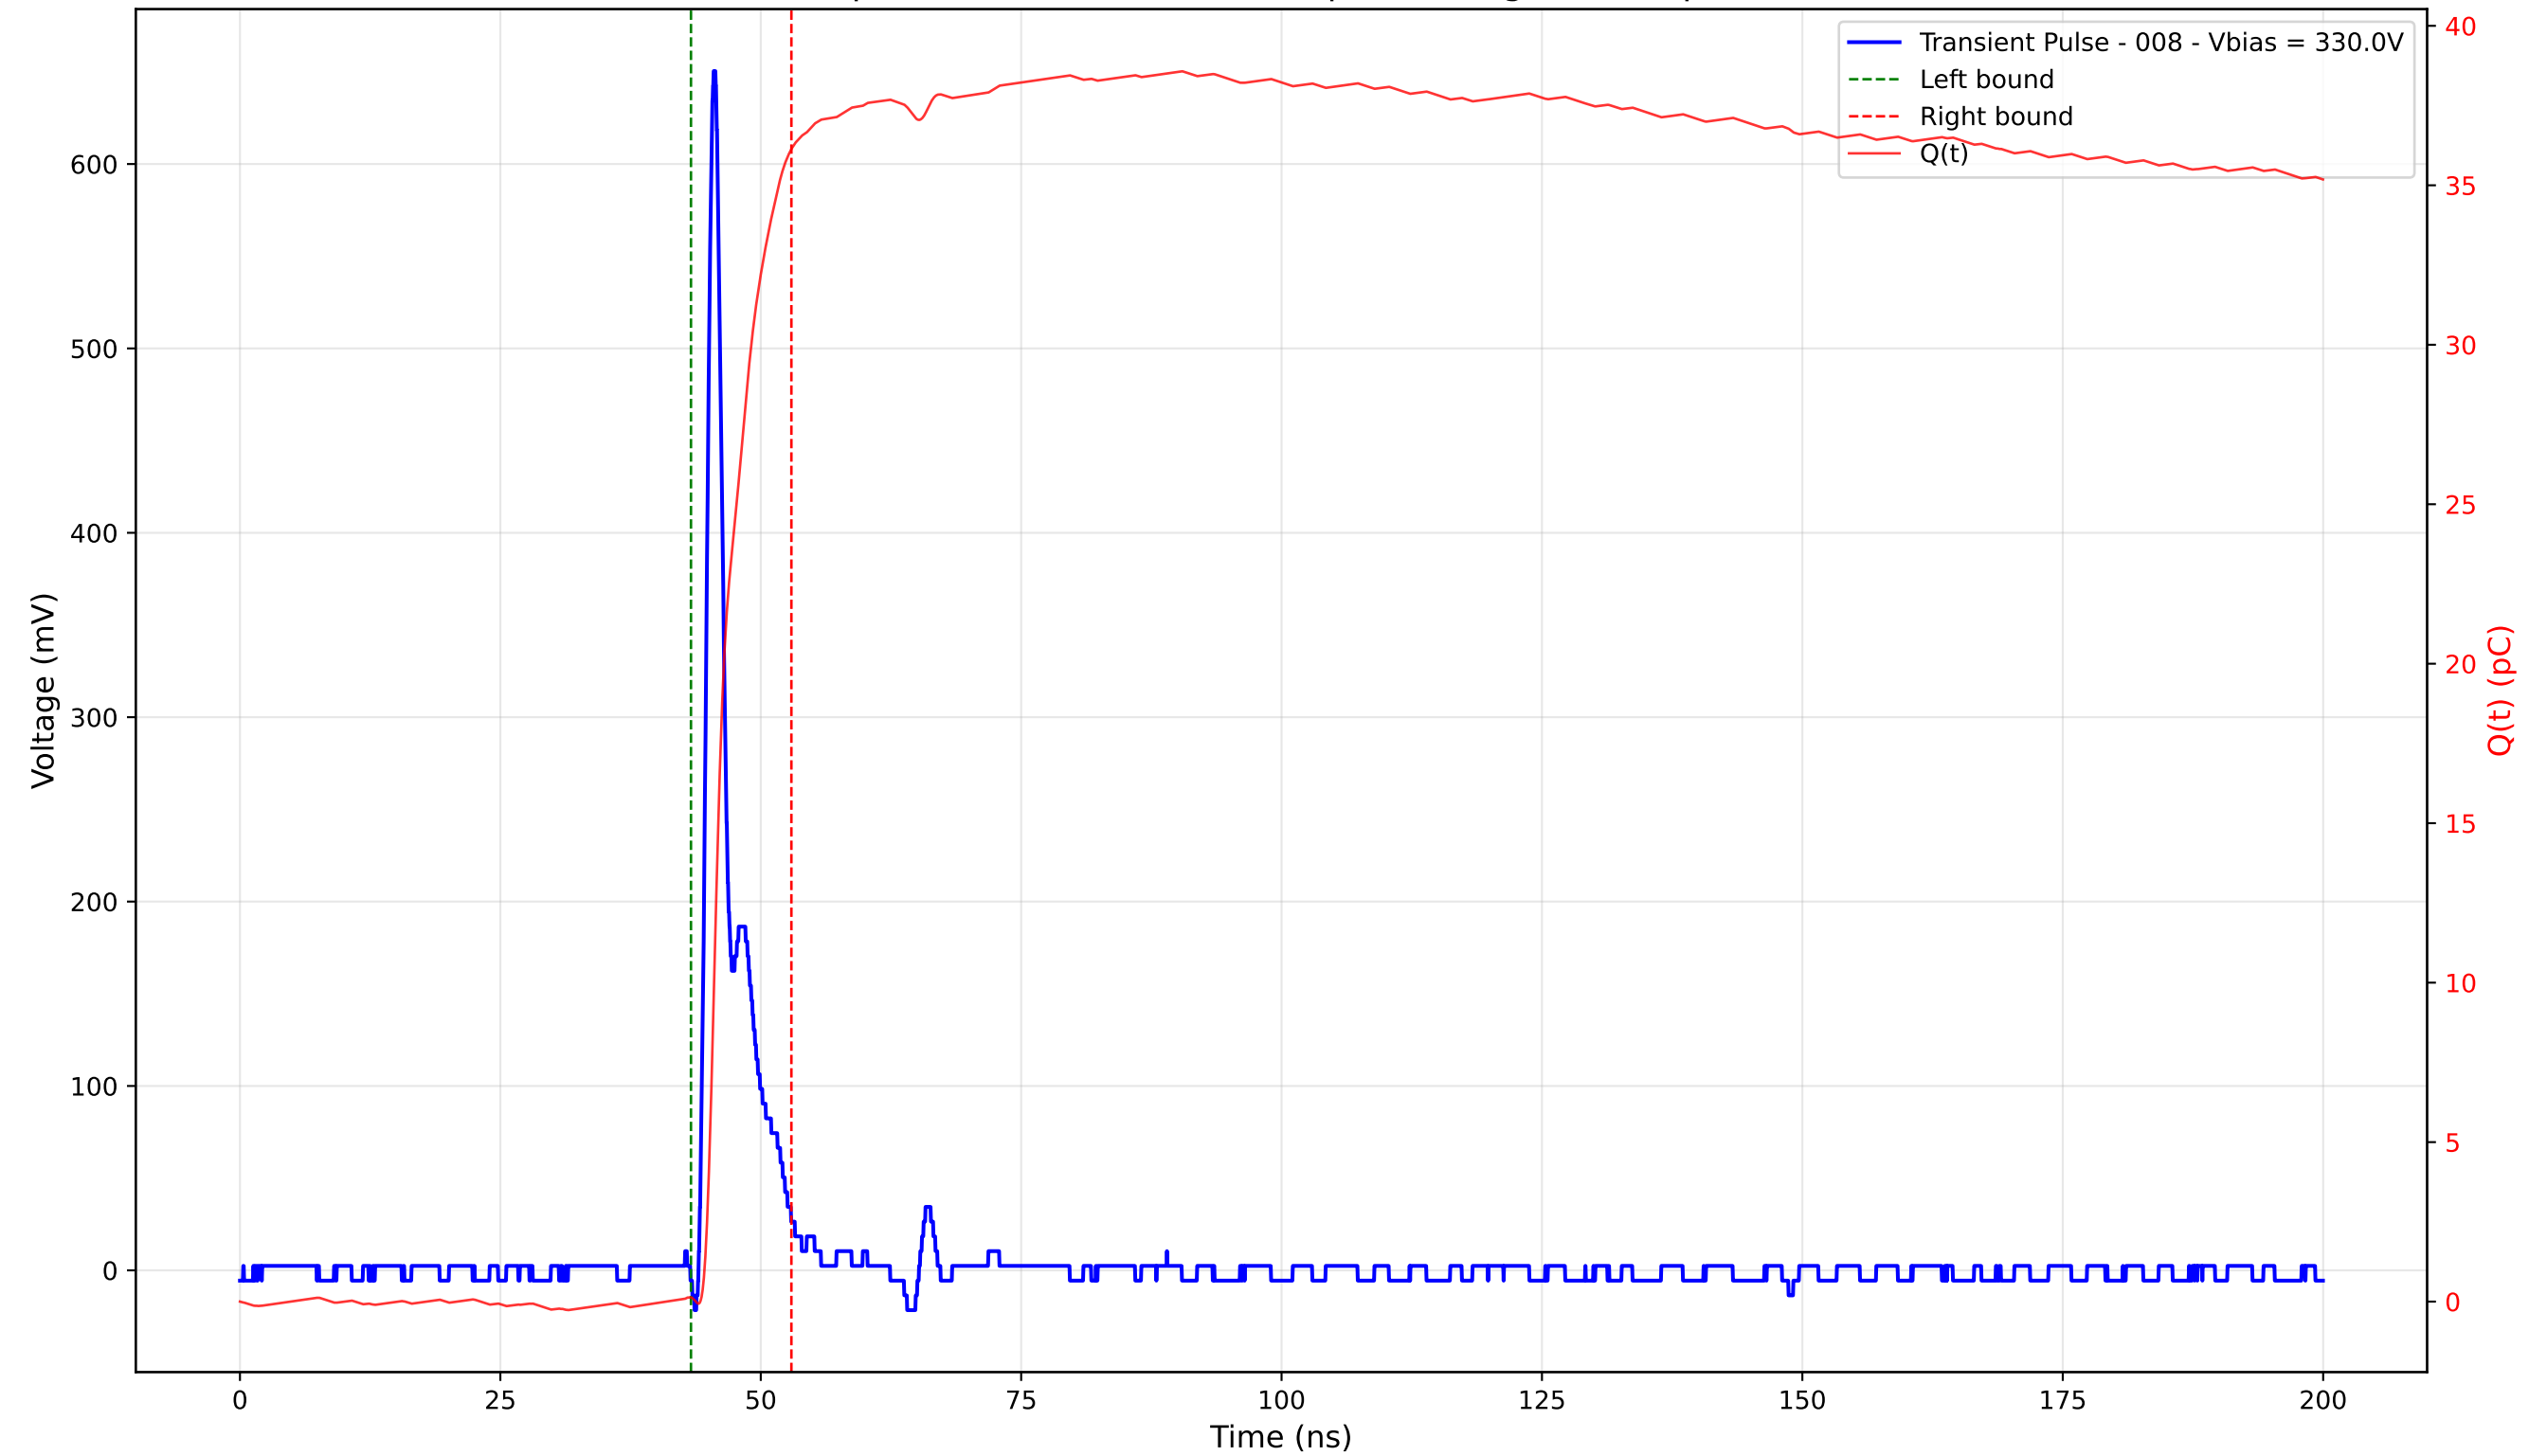


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 35.84 pC - Rise Time: 0.96 ns

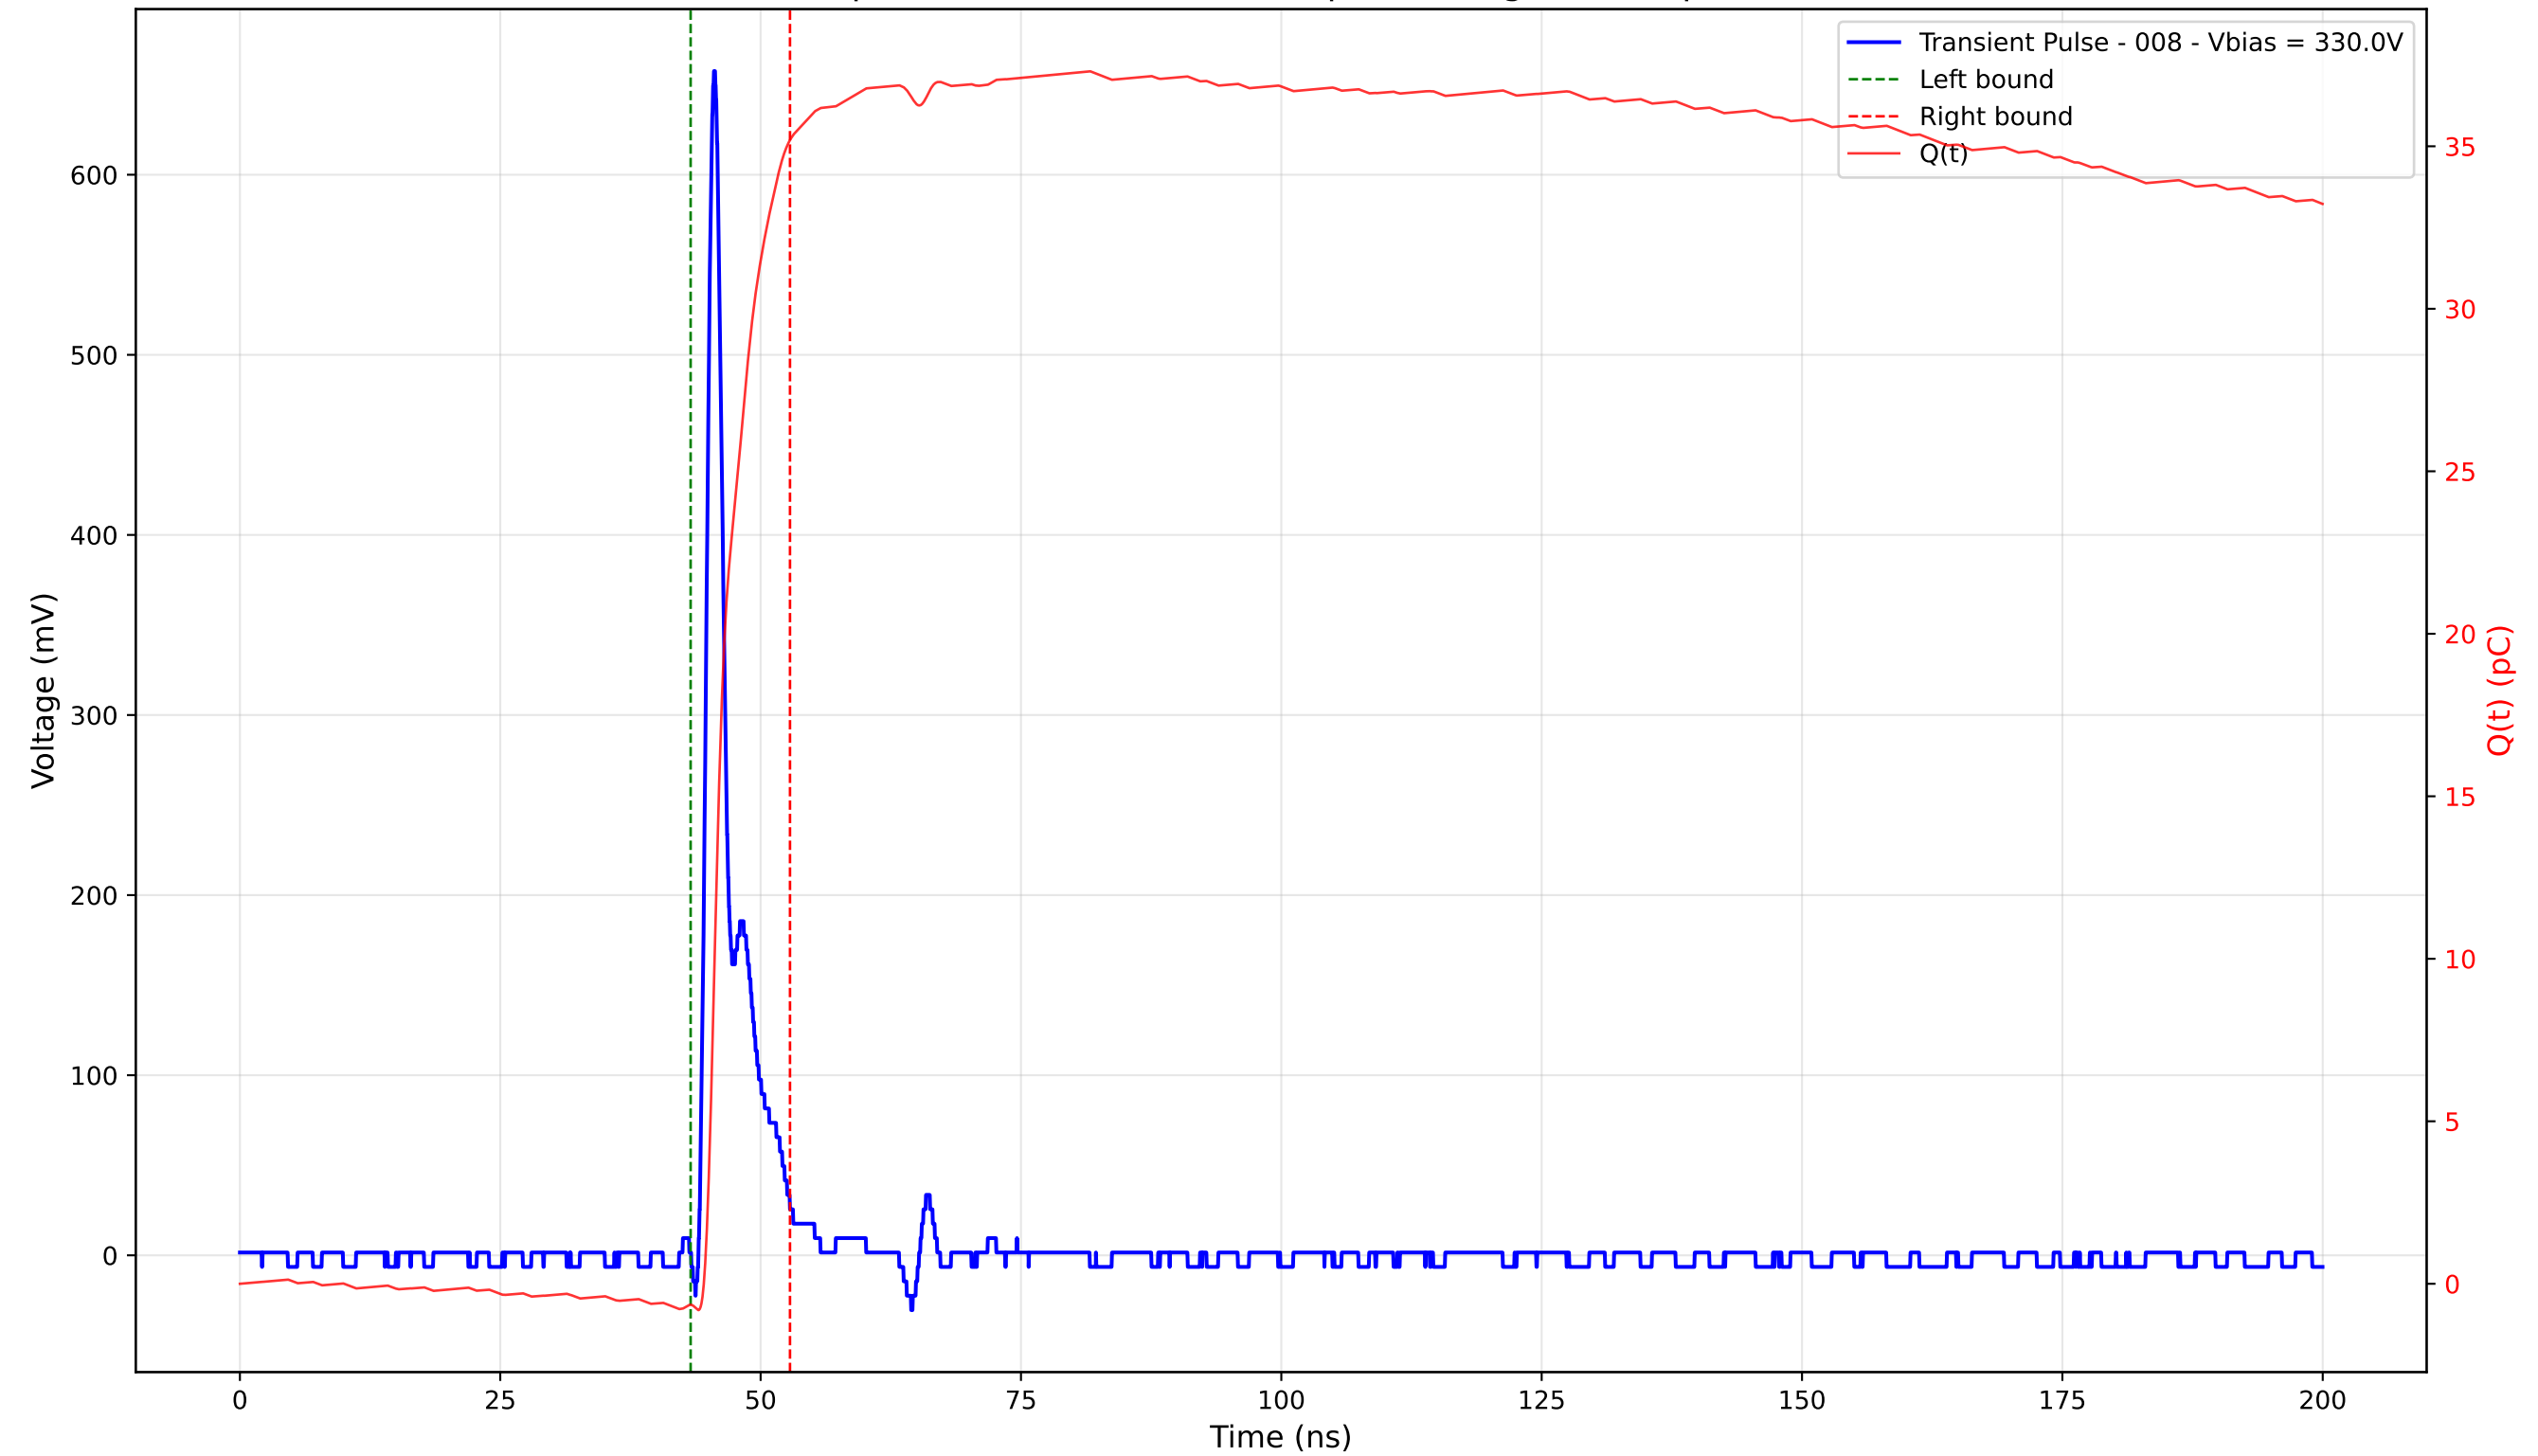


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 36.25 pC - Rise Time: 0.98 ns

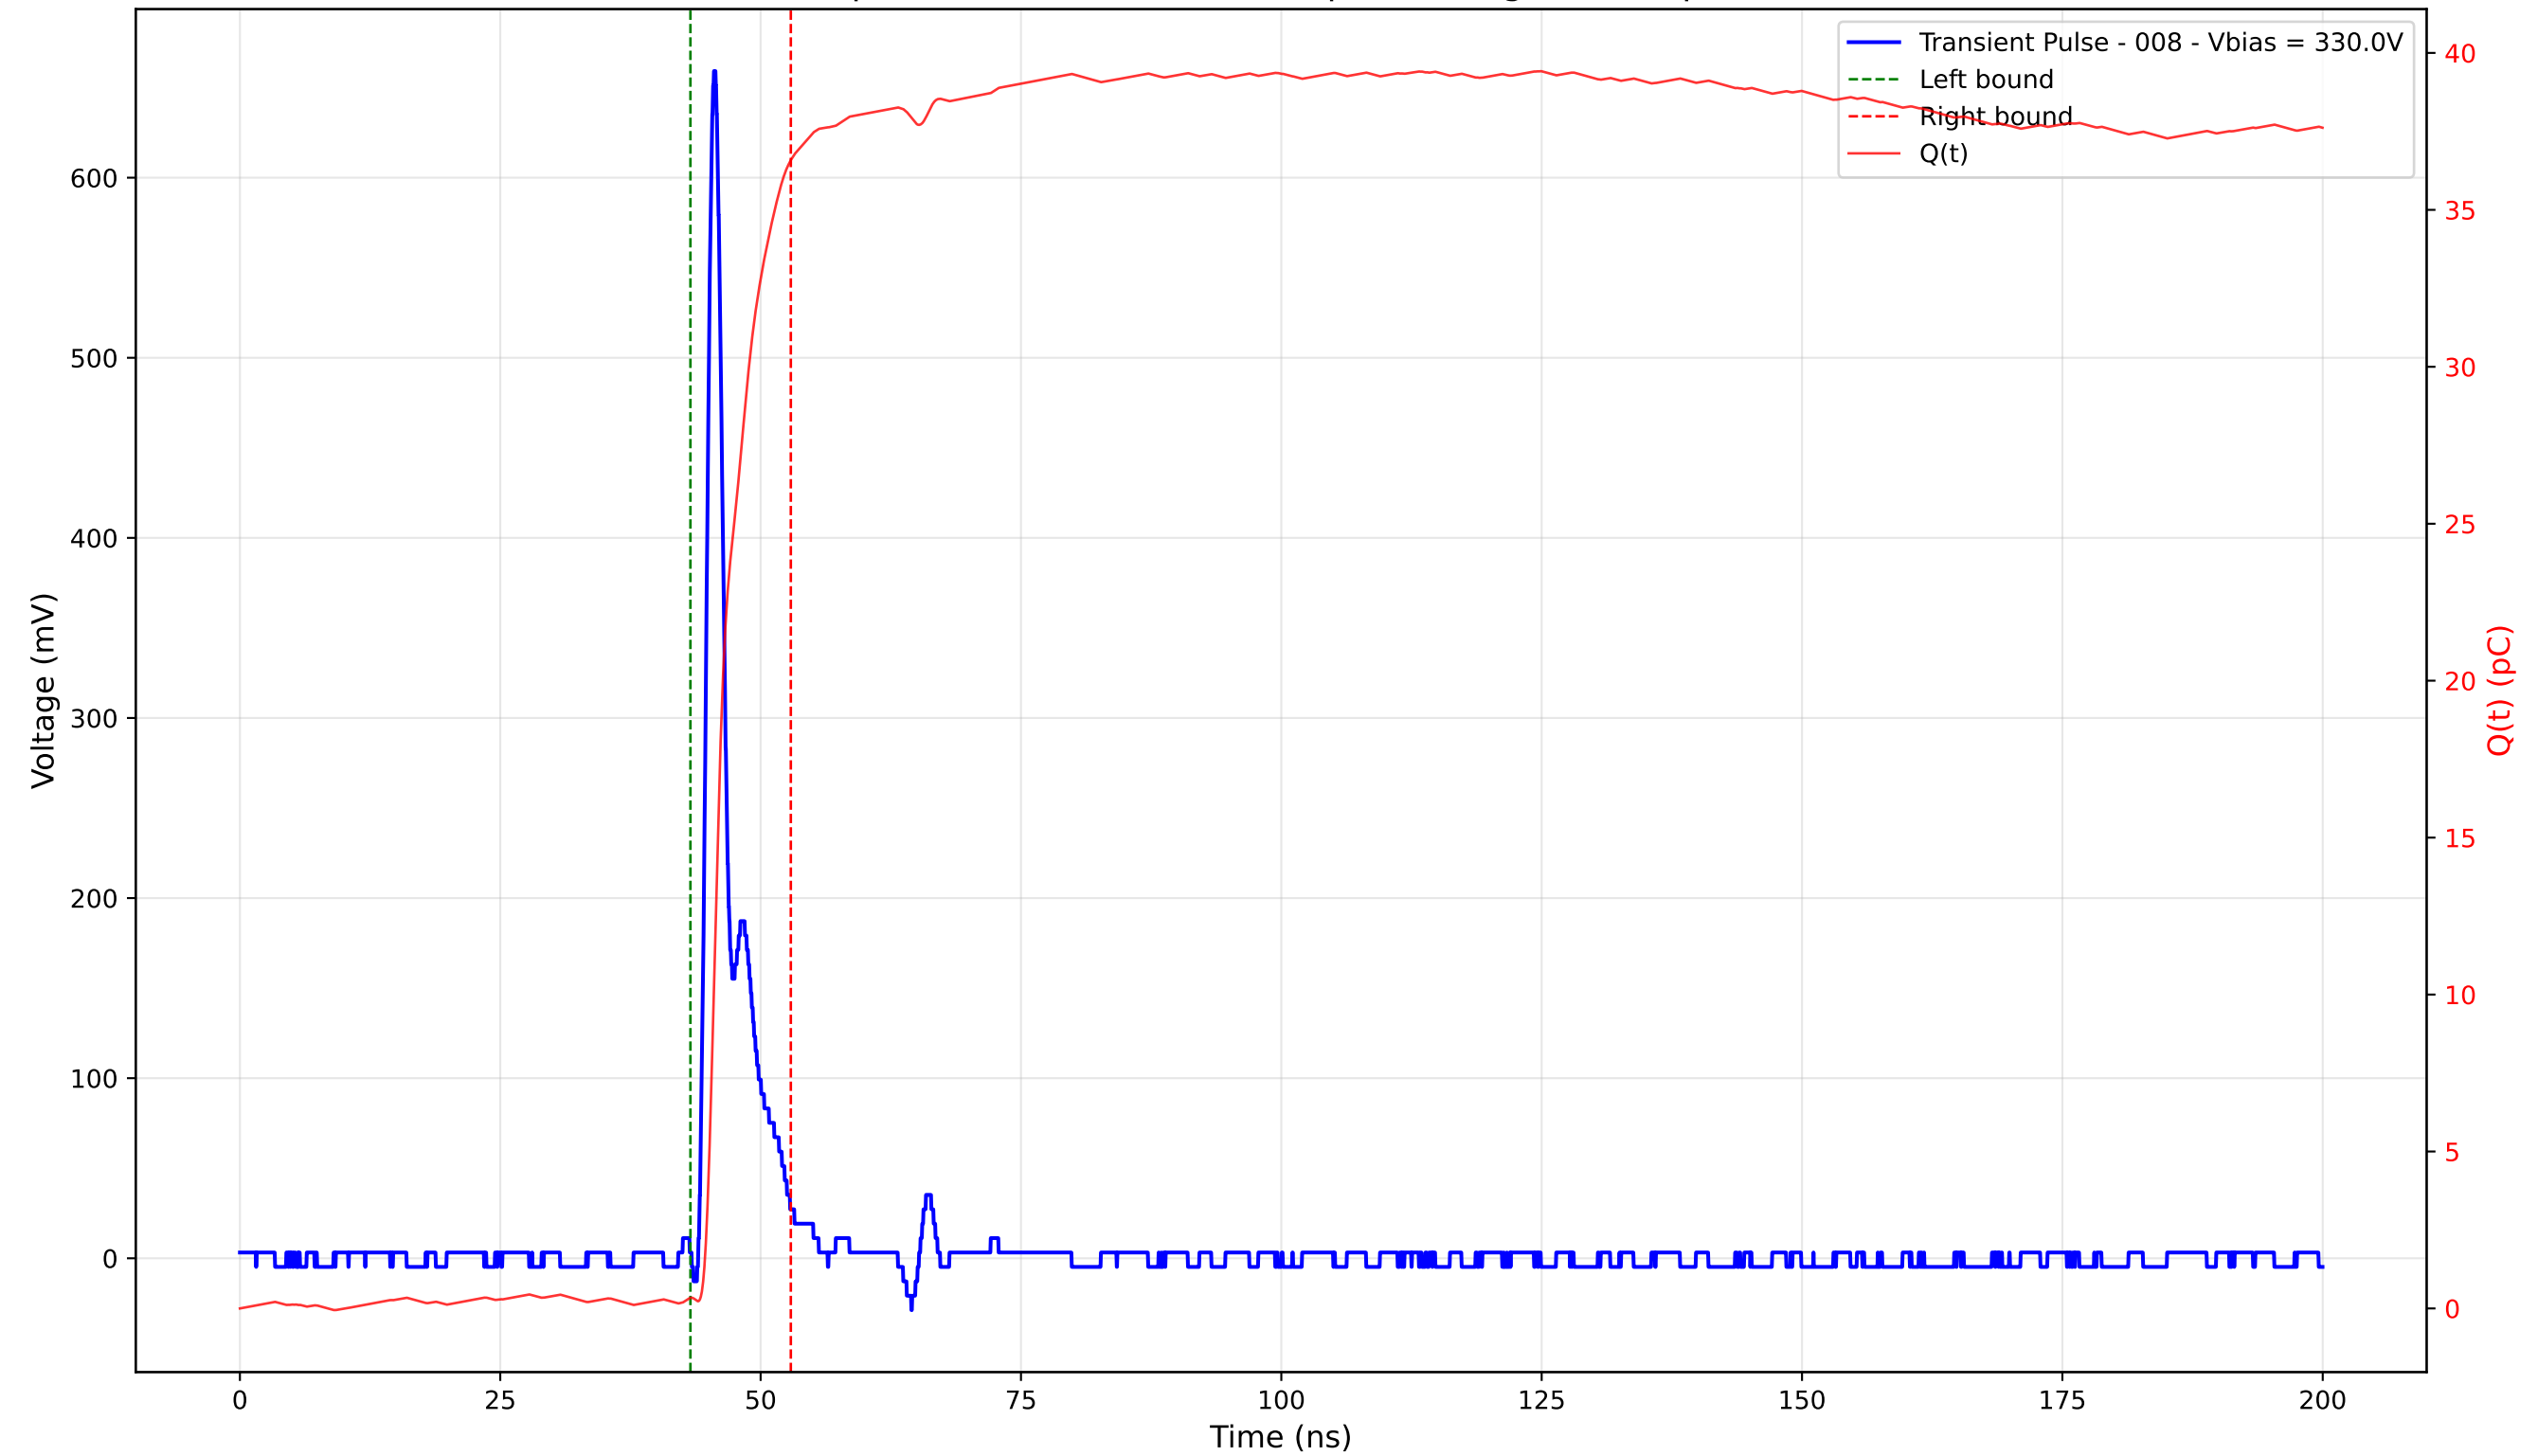


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 36.02 pC - Rise Time: 0.97 ns

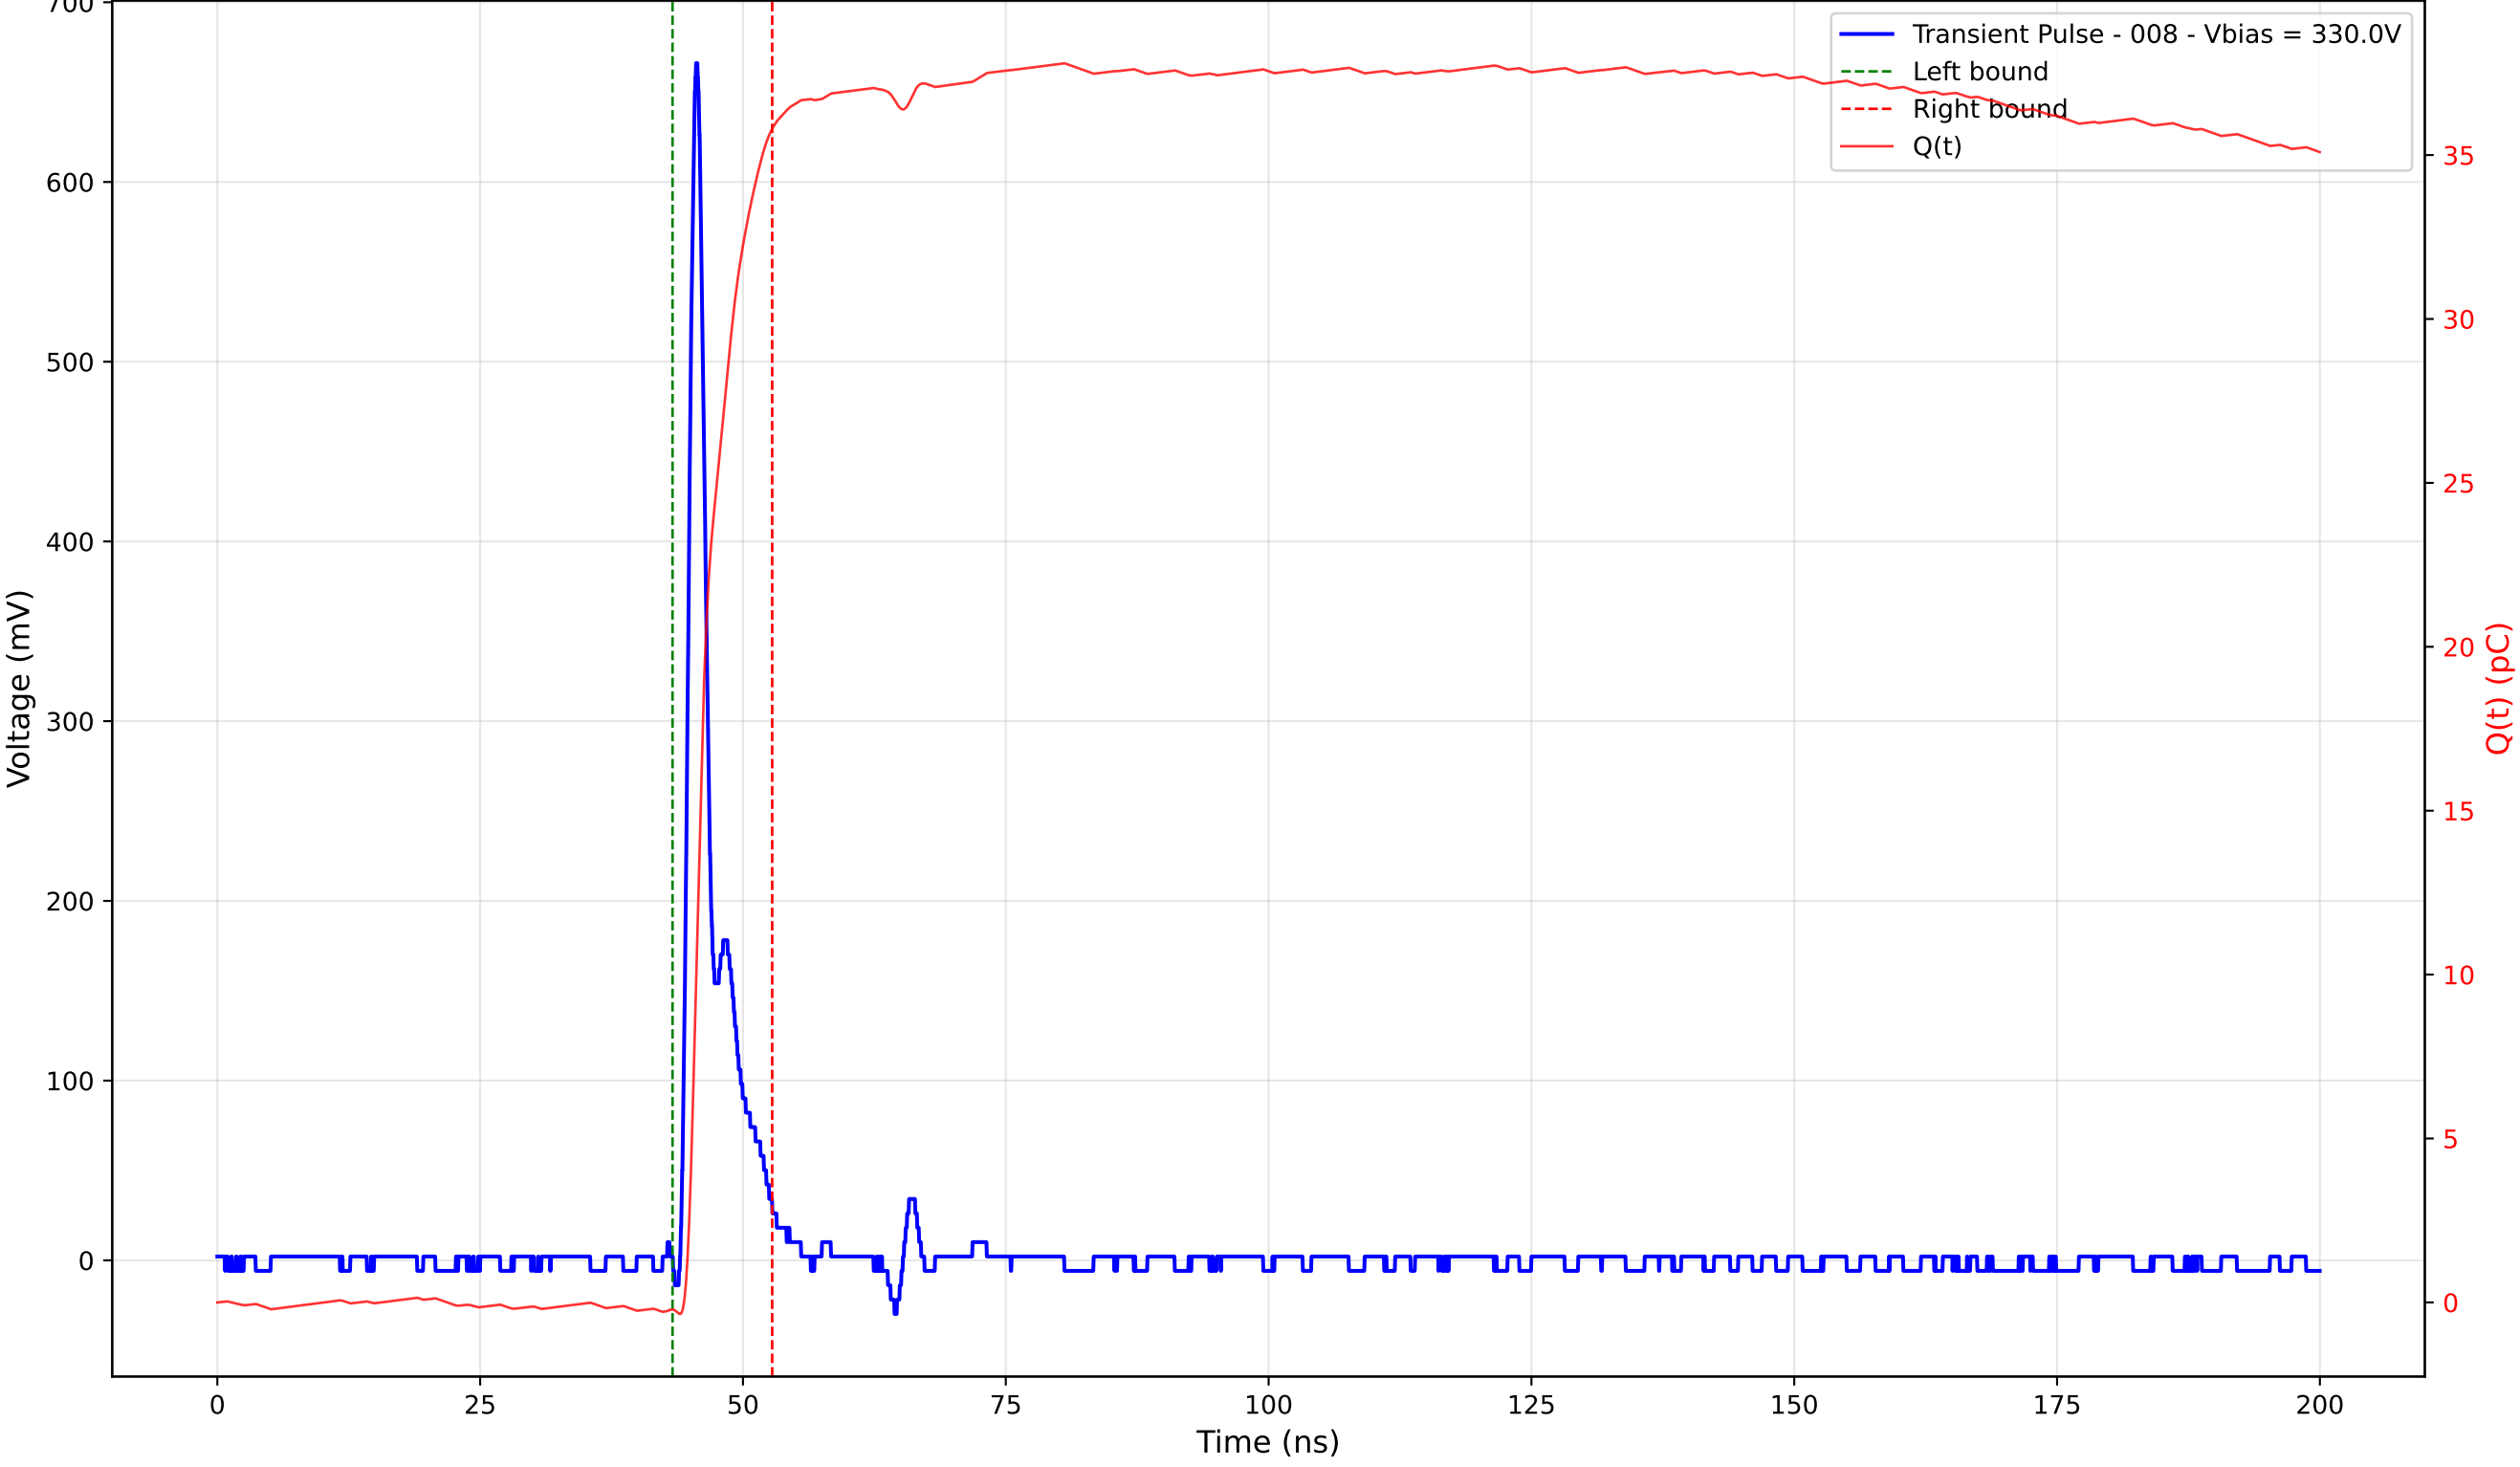


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 36.30 pC - Rise Time: 1.00 ns

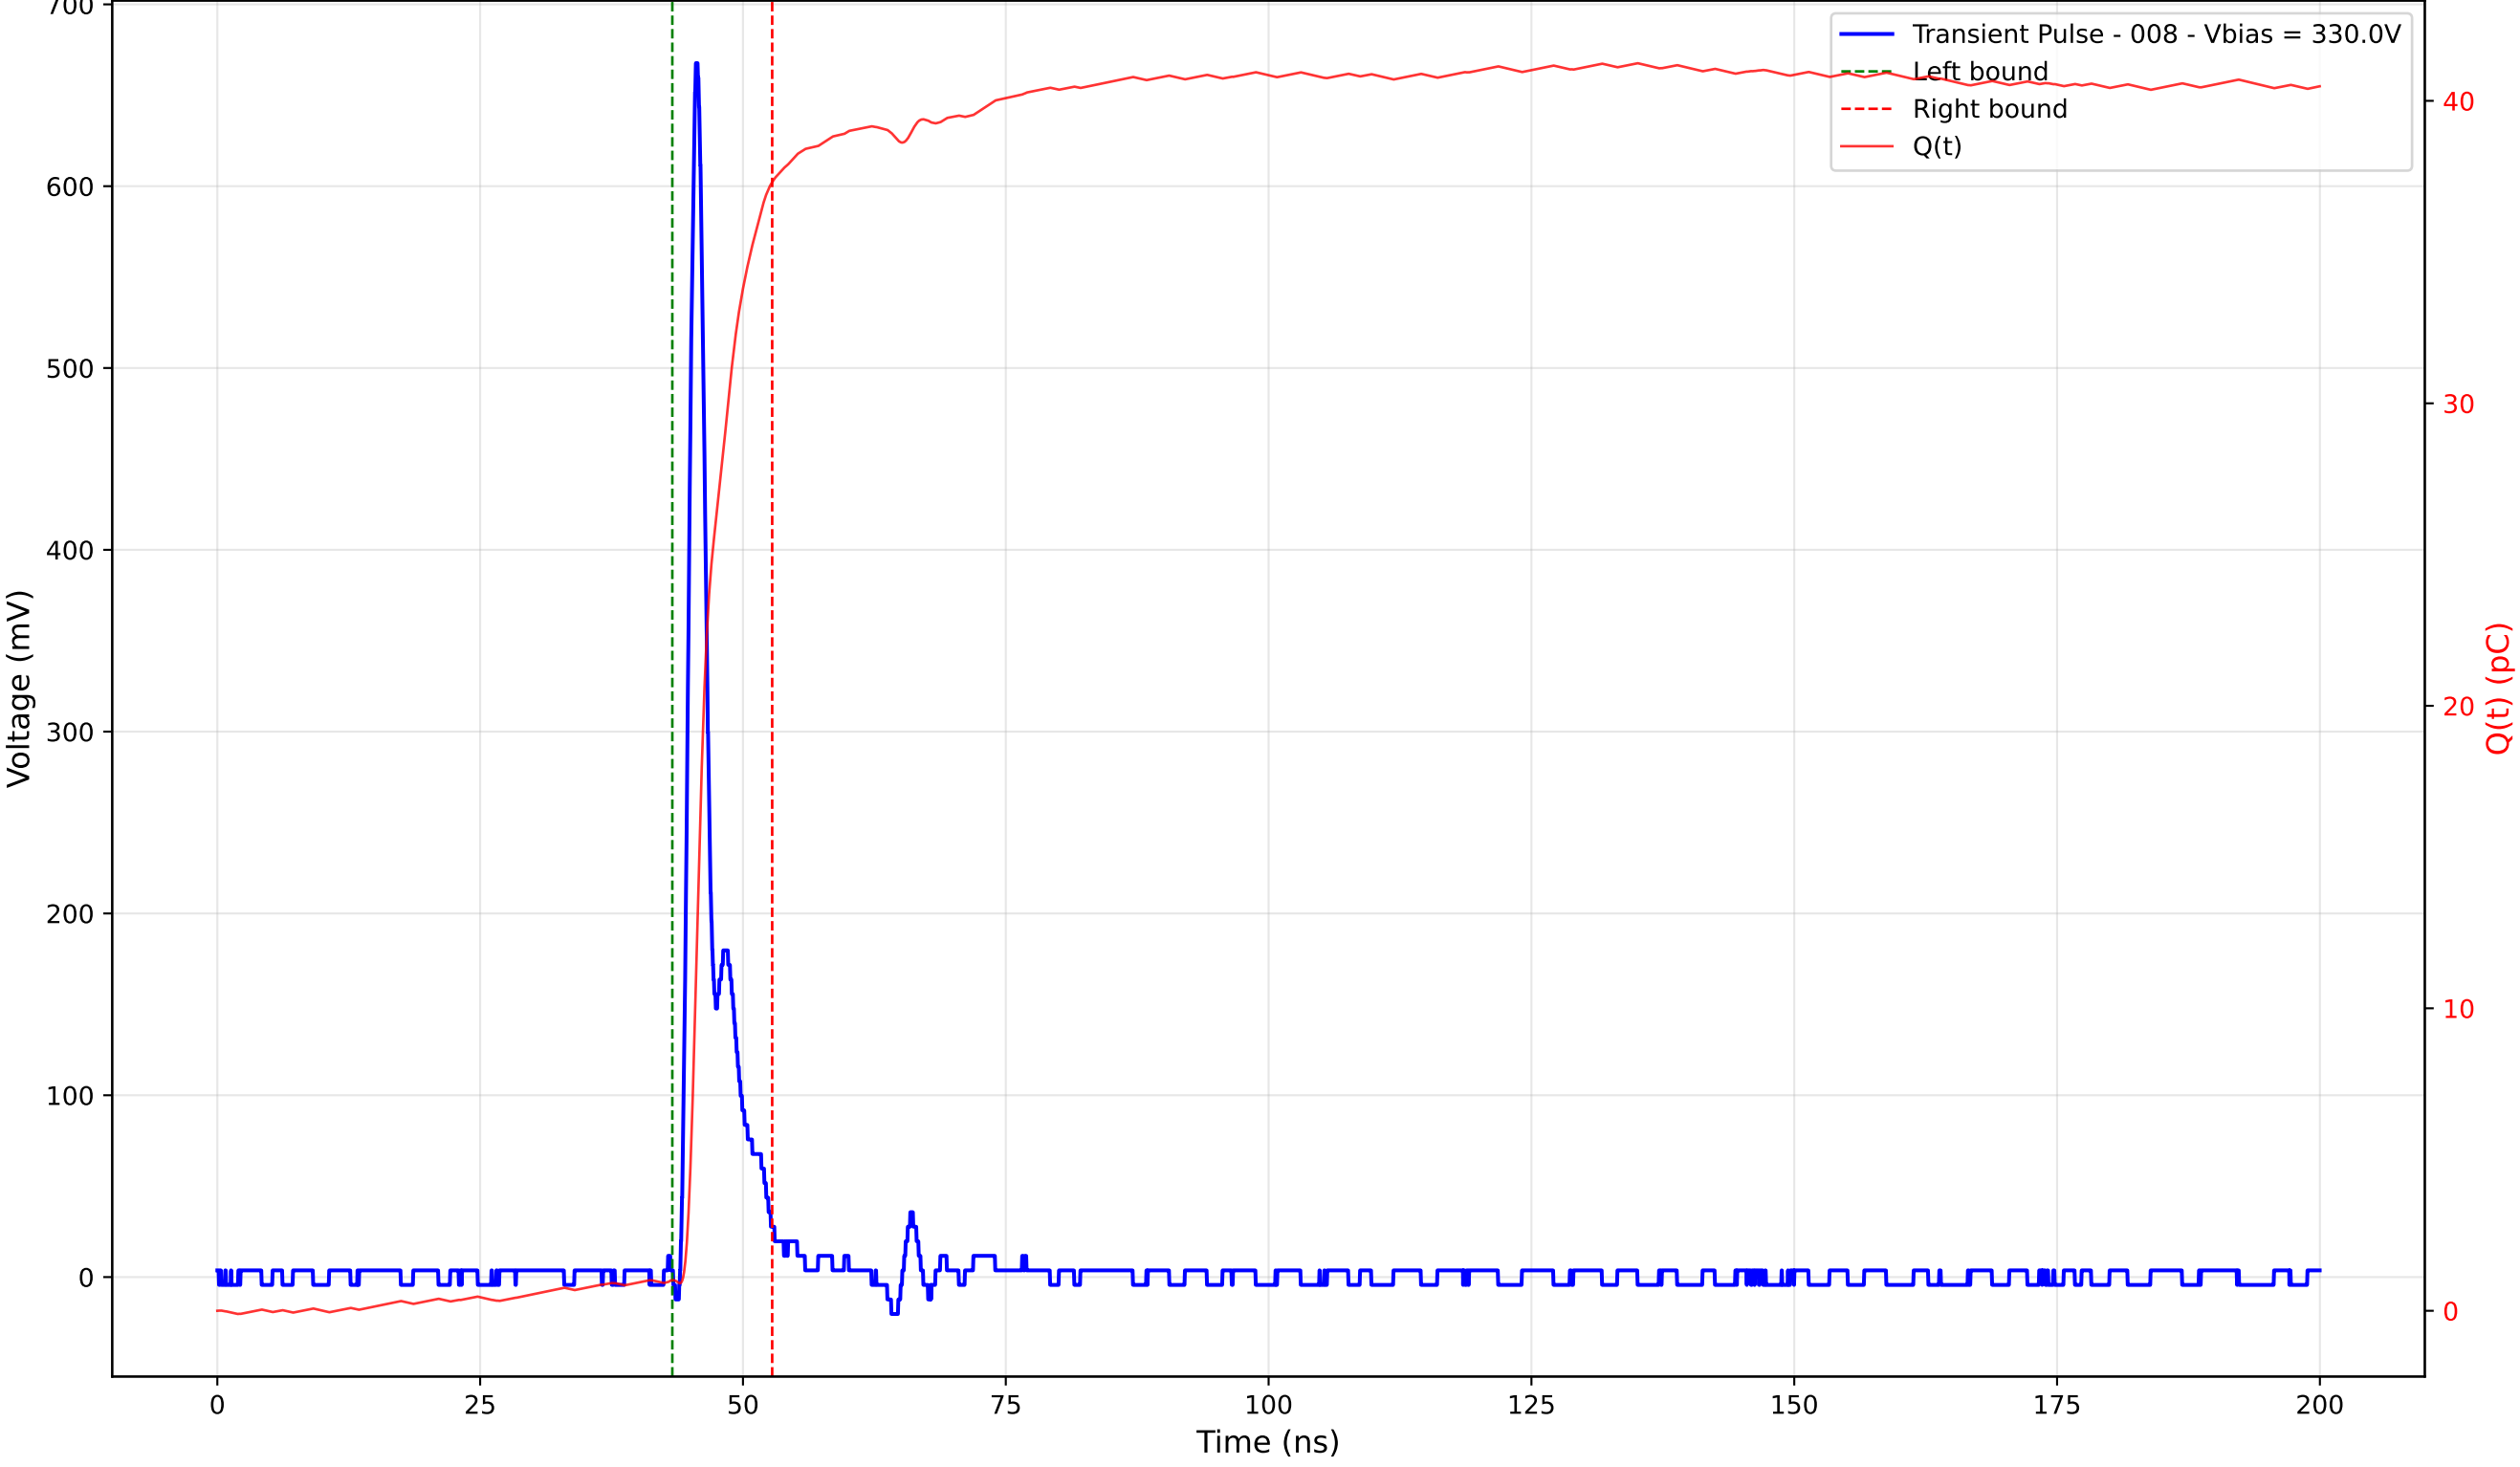


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 35.97 pC - Rise Time: 0.99 ns

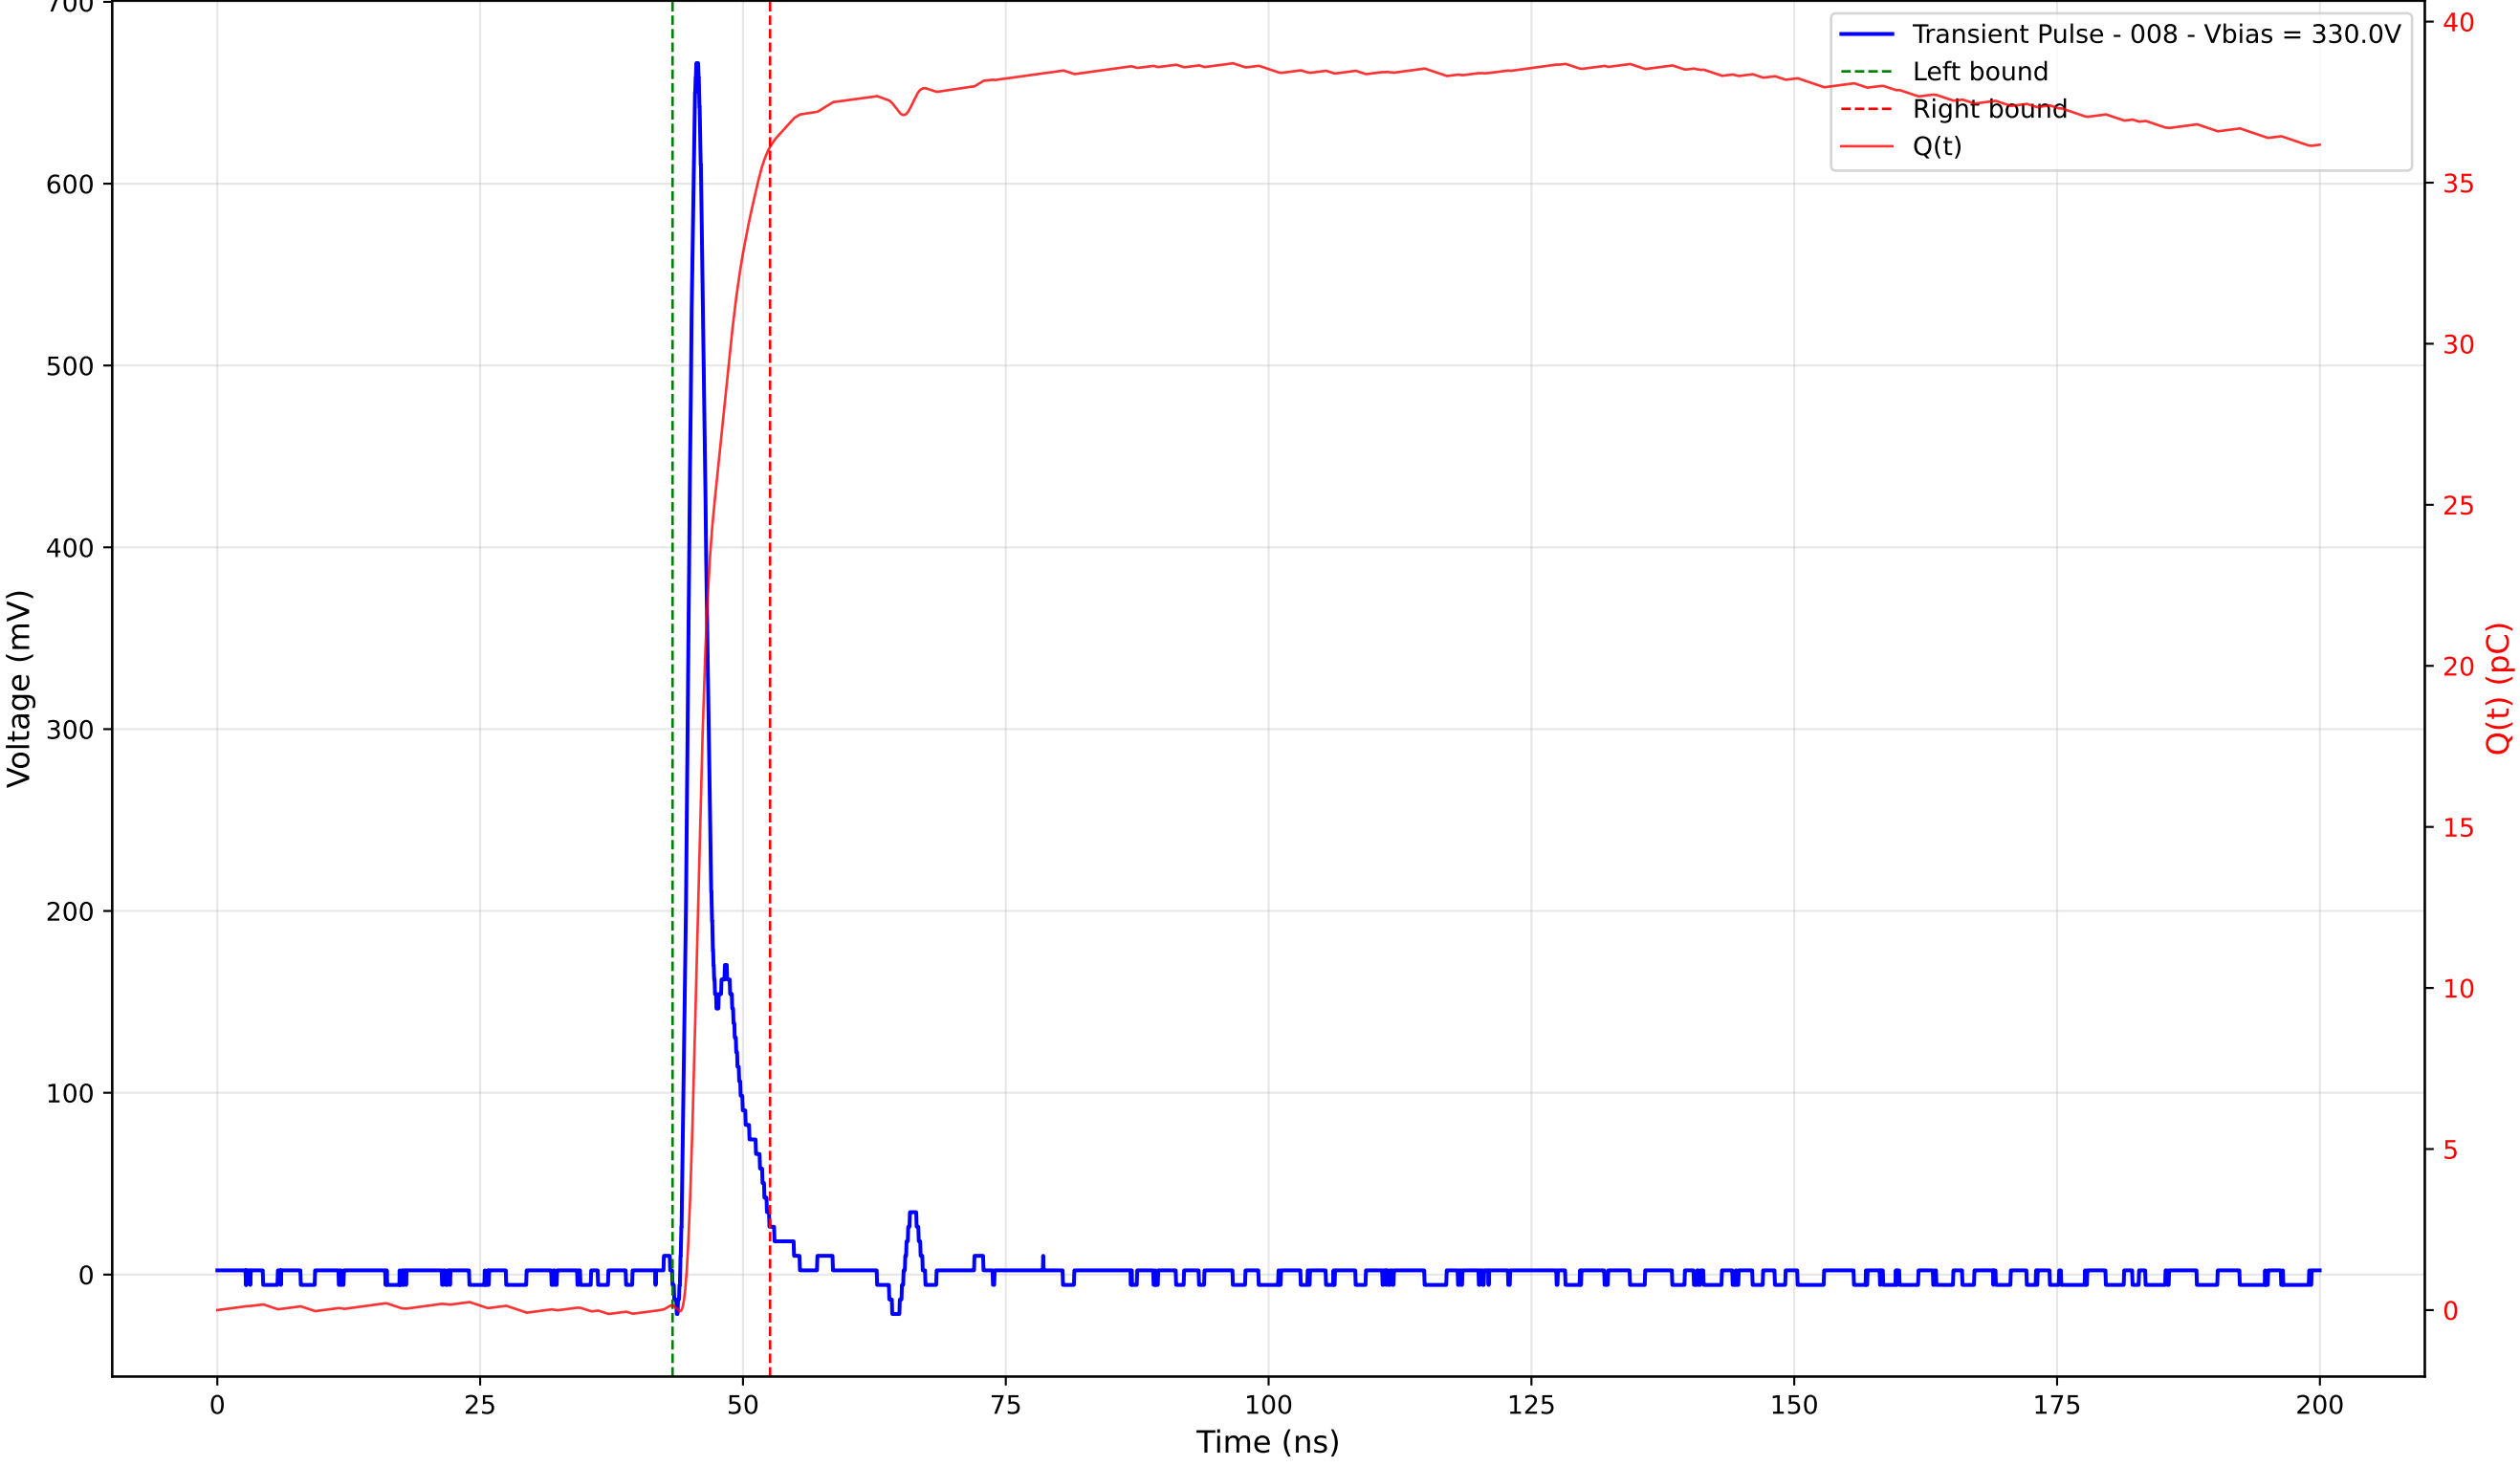


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 35.85 pC - Rise Time: 0.98 ns

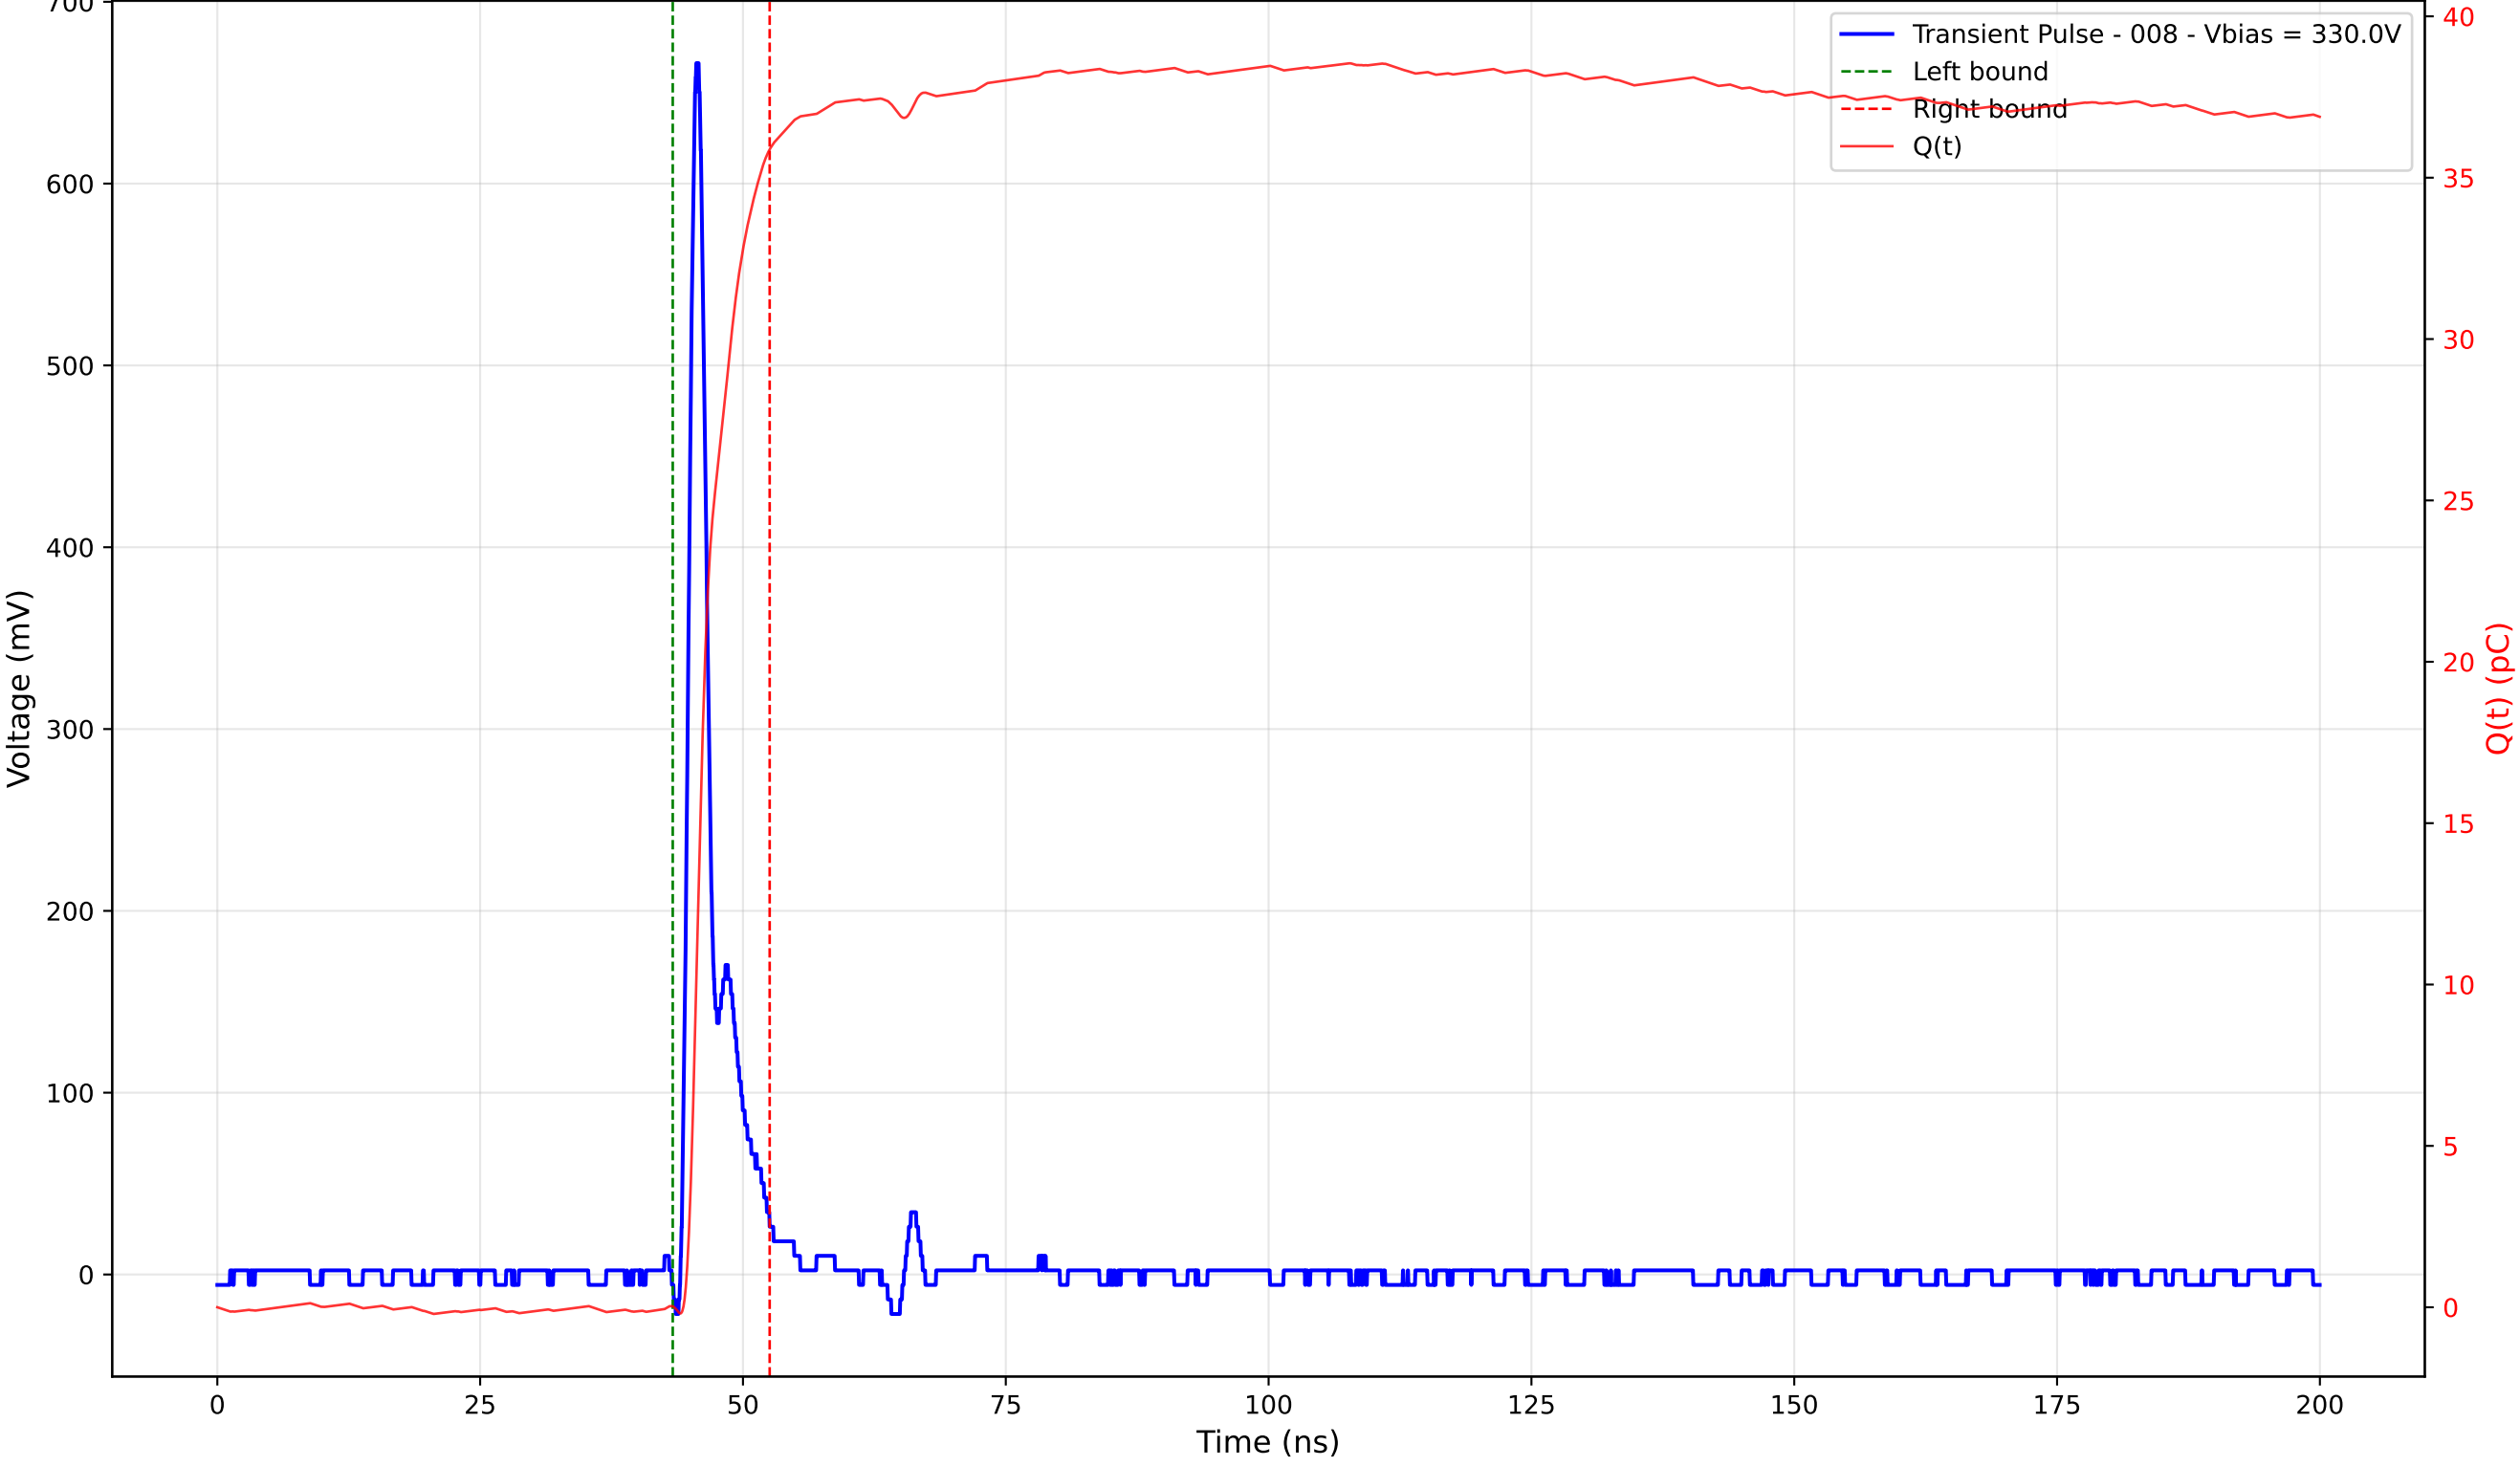


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 36.17 pC - Rise Time: 1.03 ns

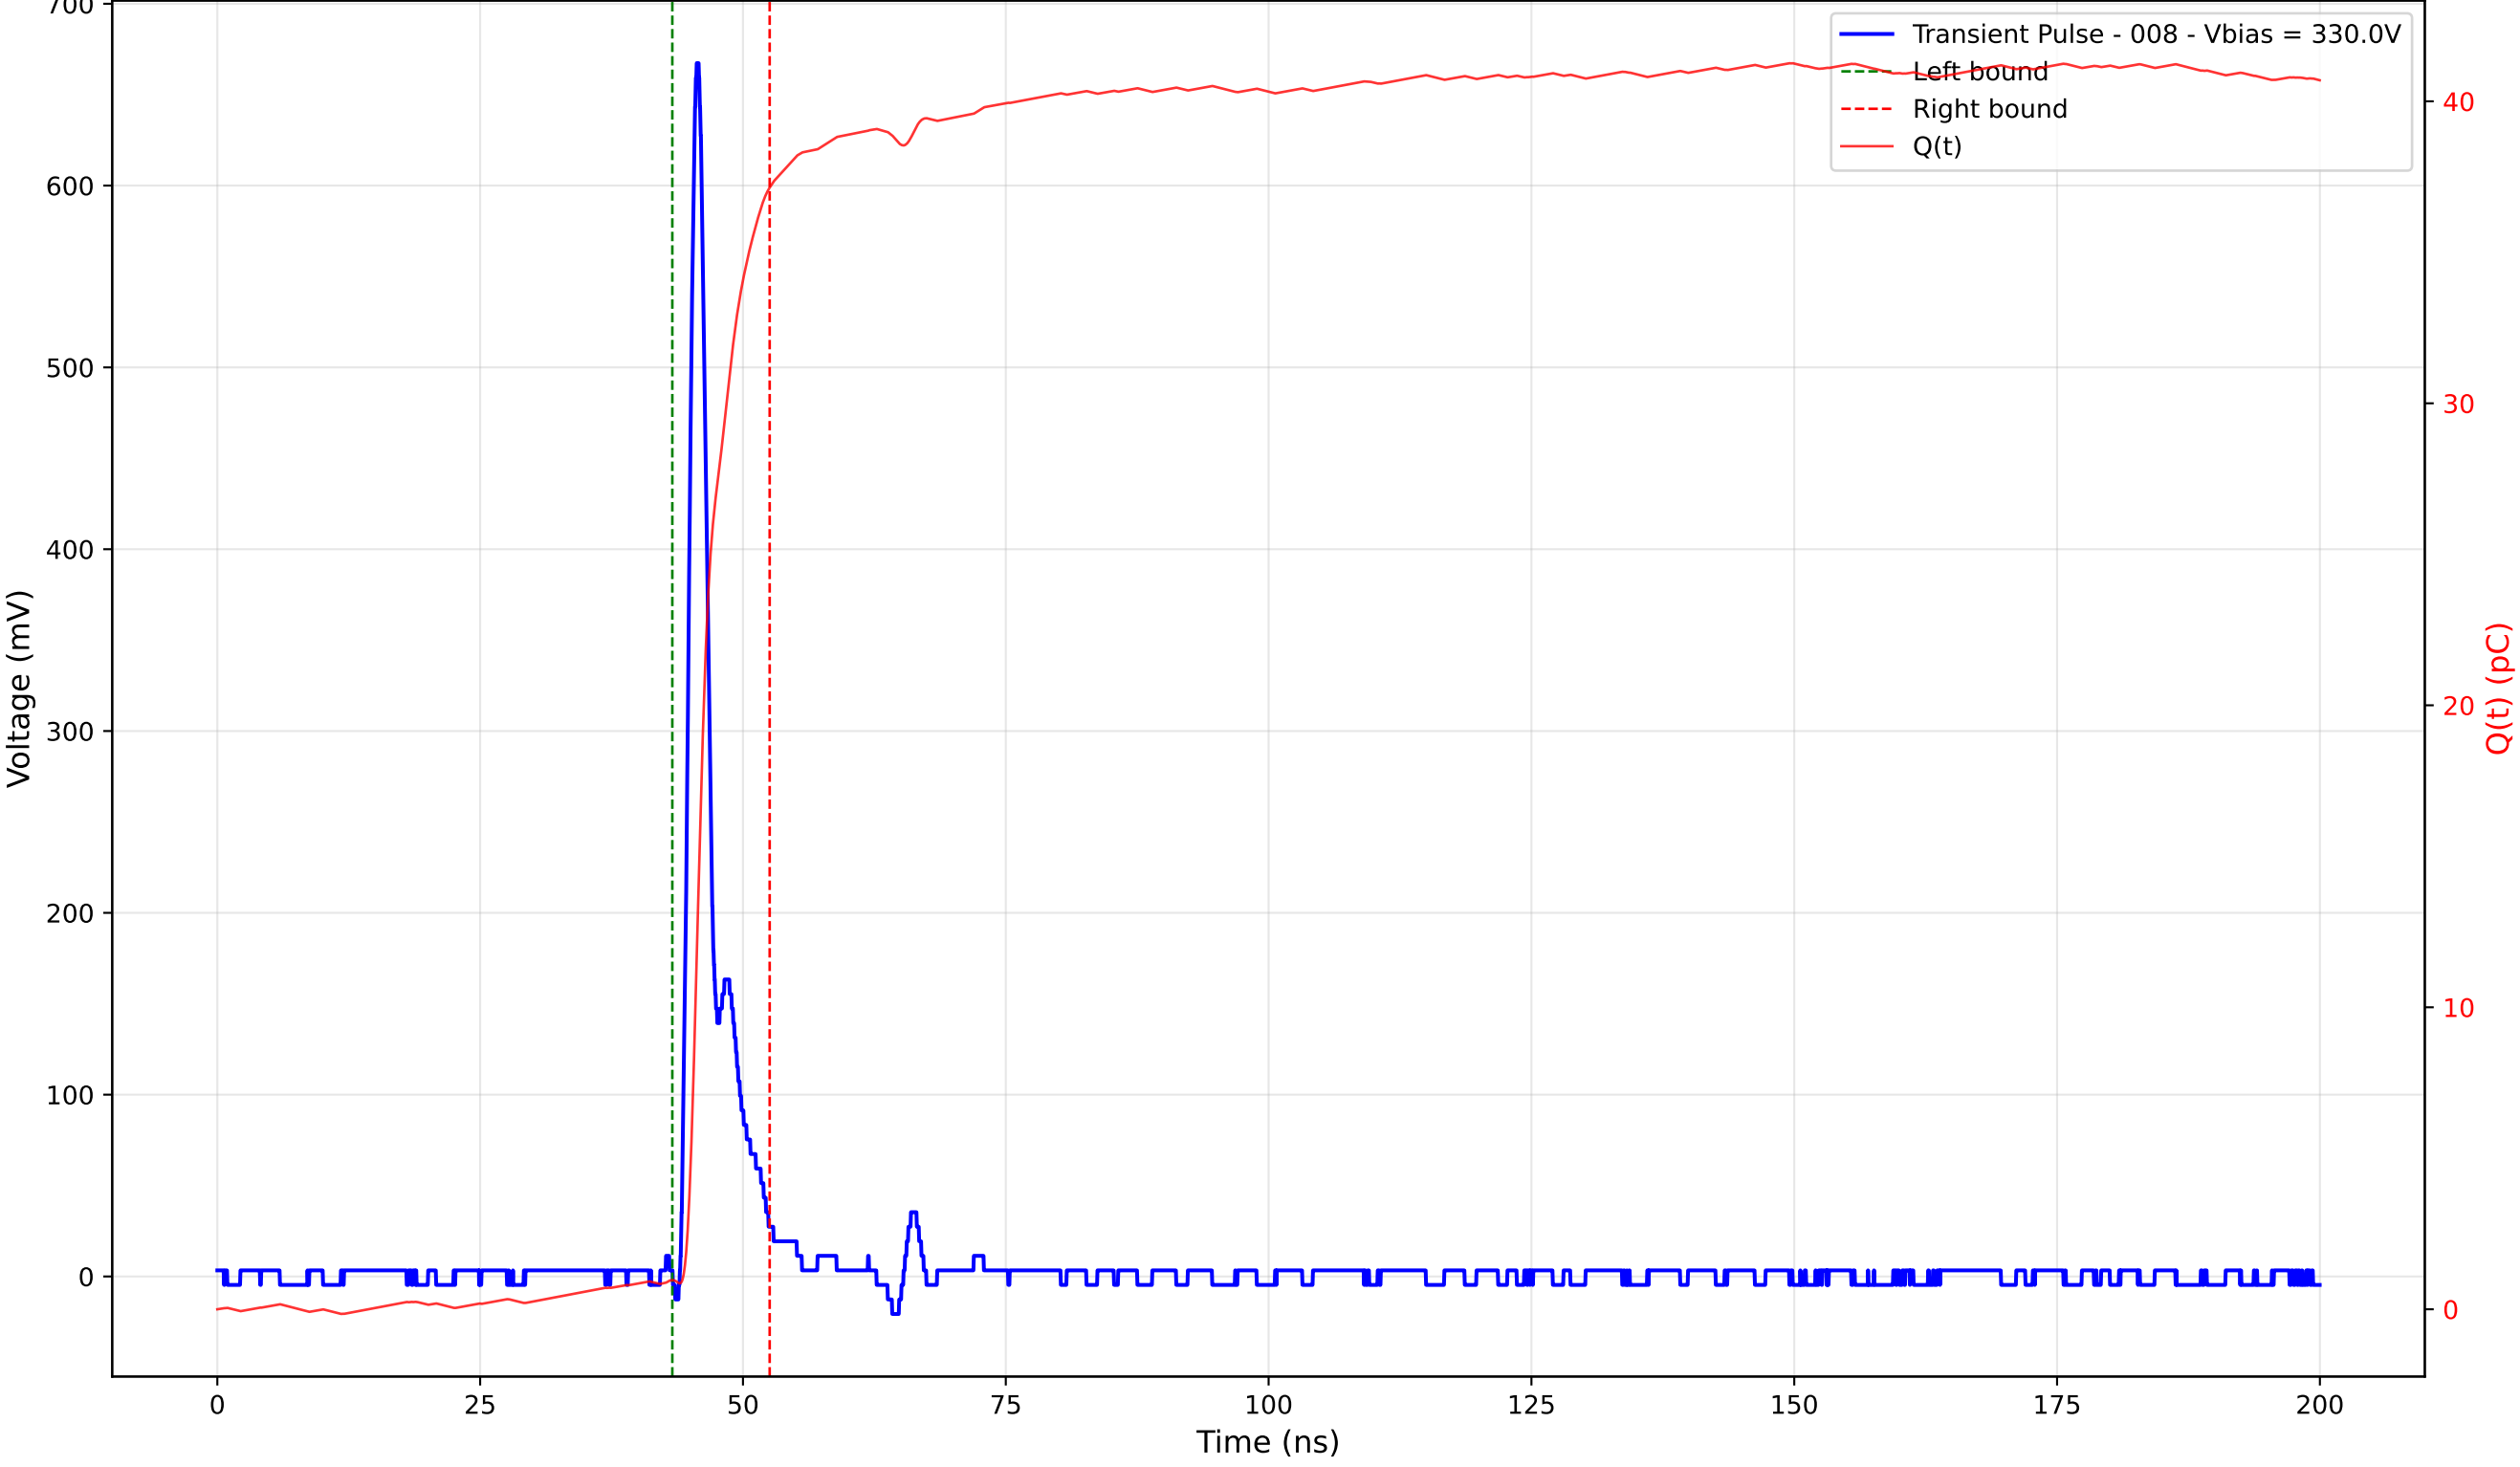


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 35.93 pC - Rise Time: 1.03 ns

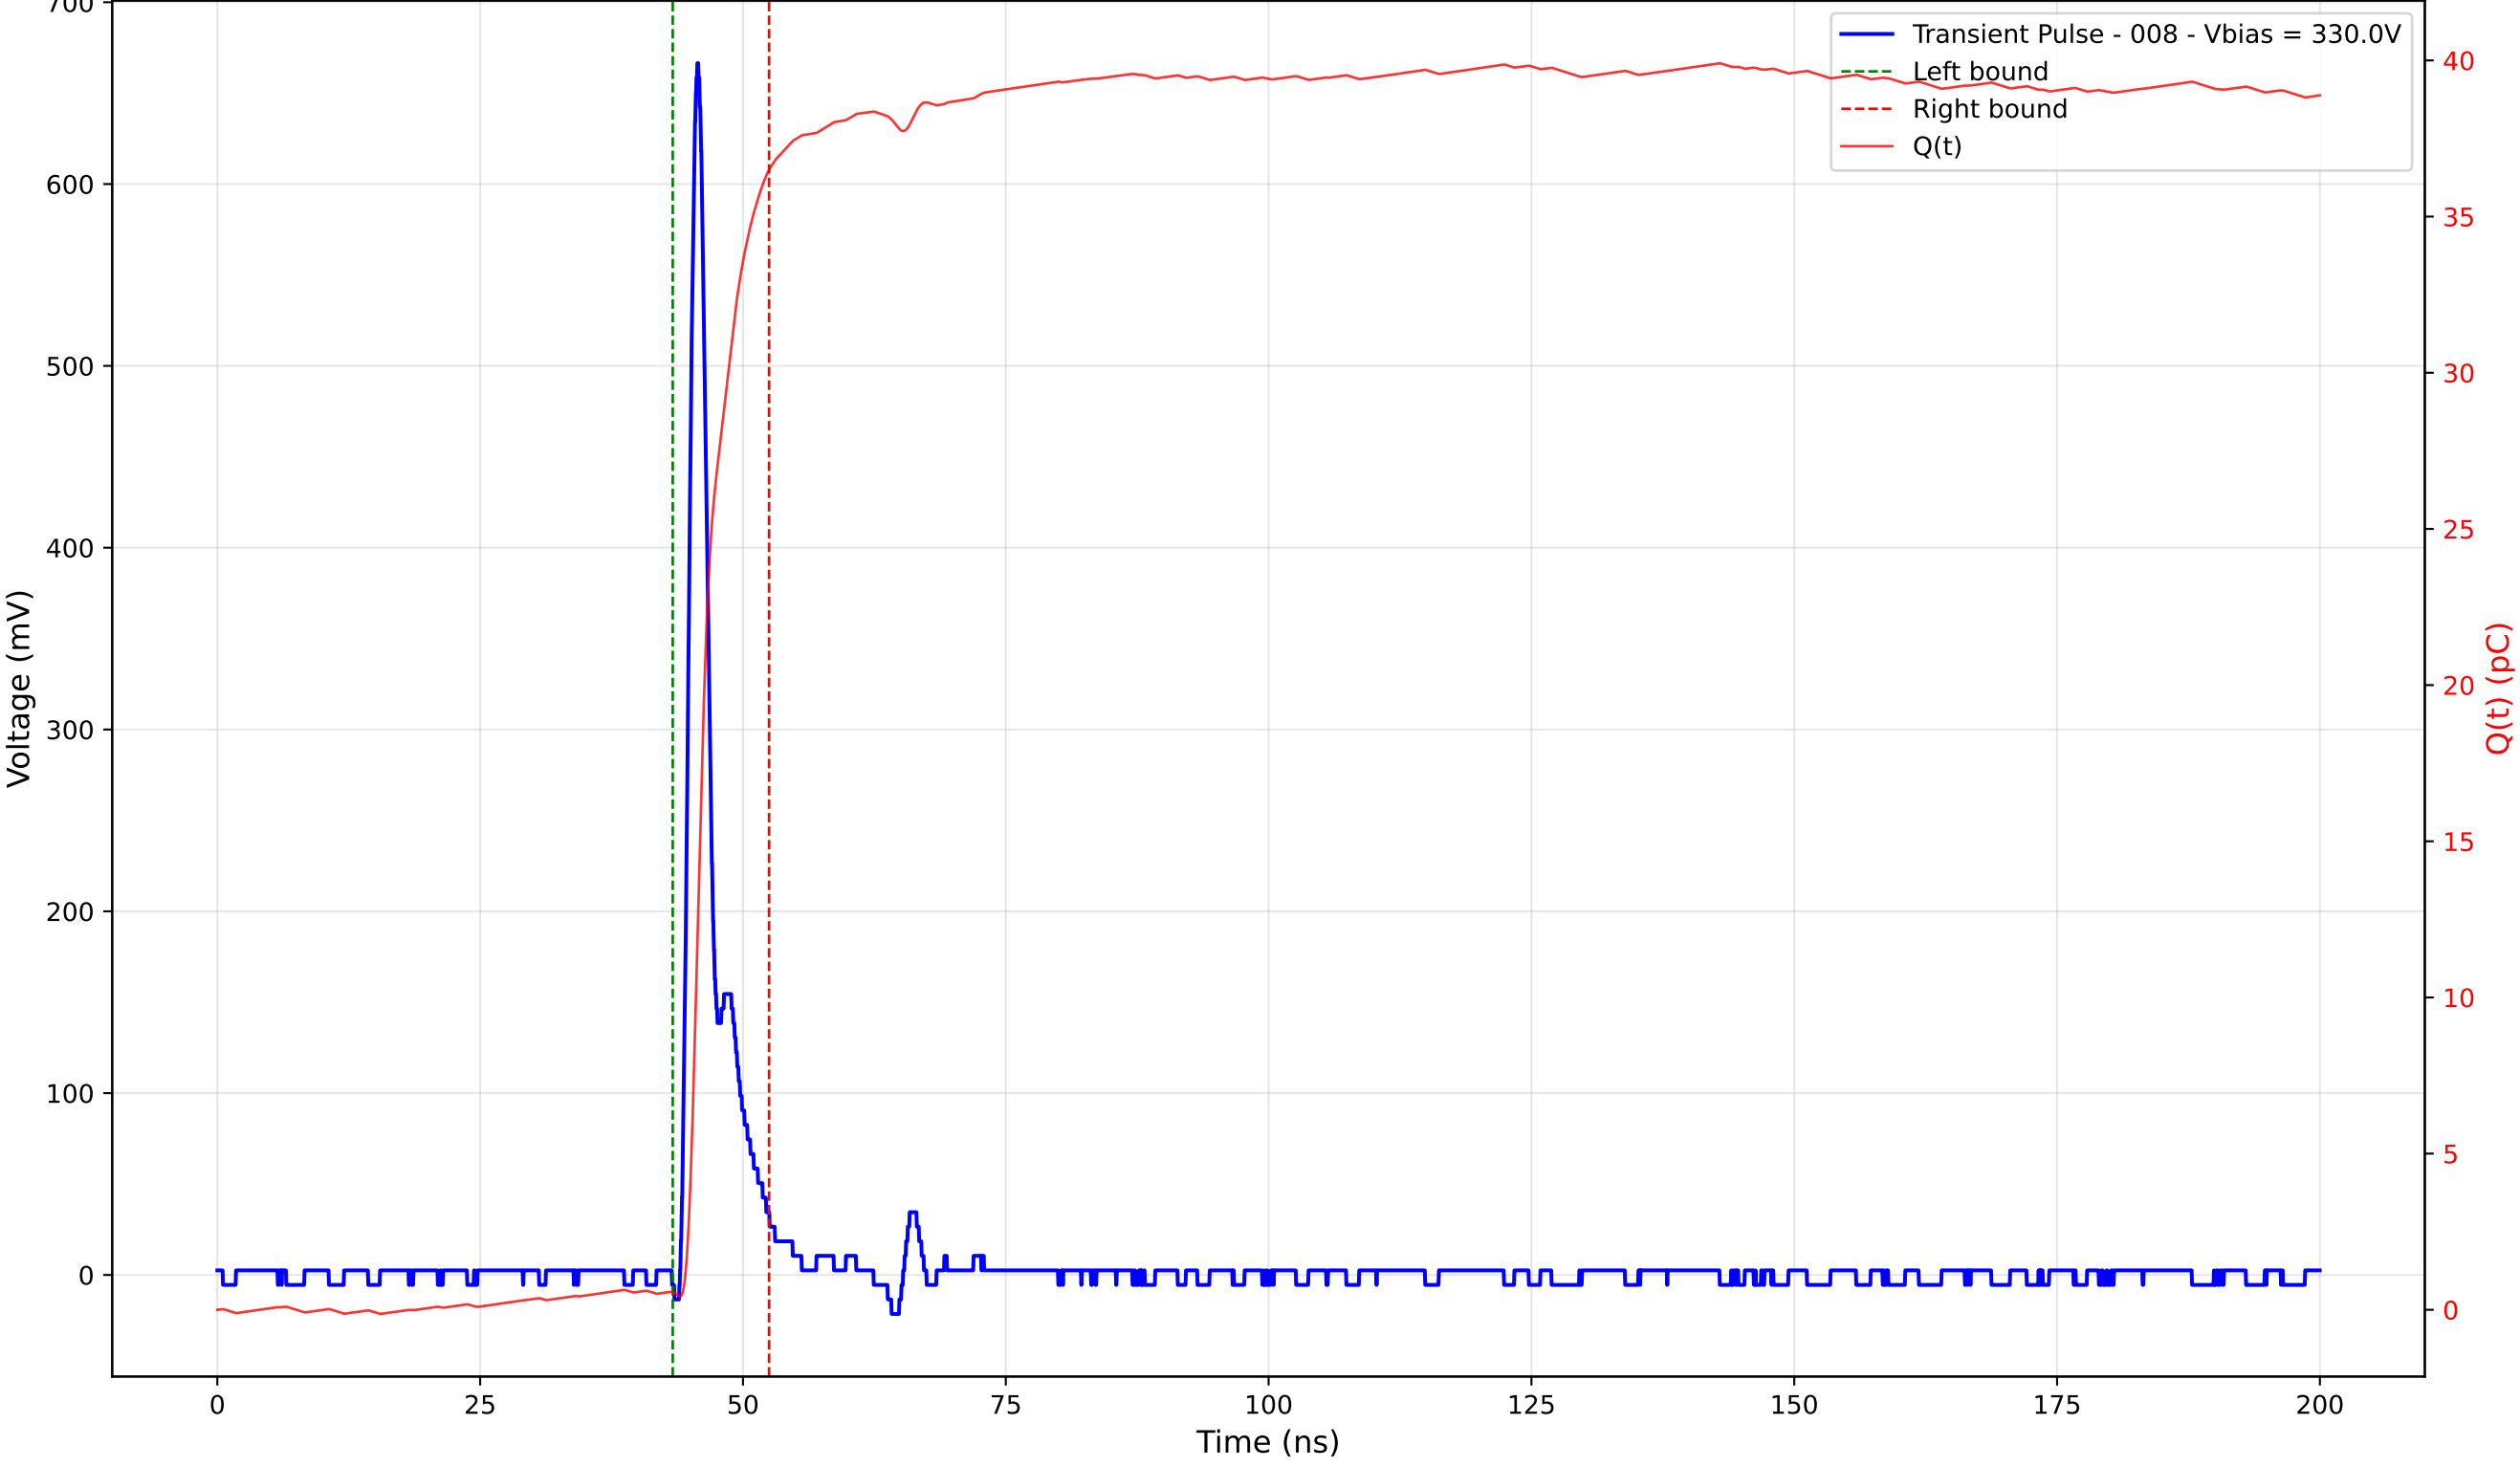


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 35.64 pC - Rise Time: 1.06 ns

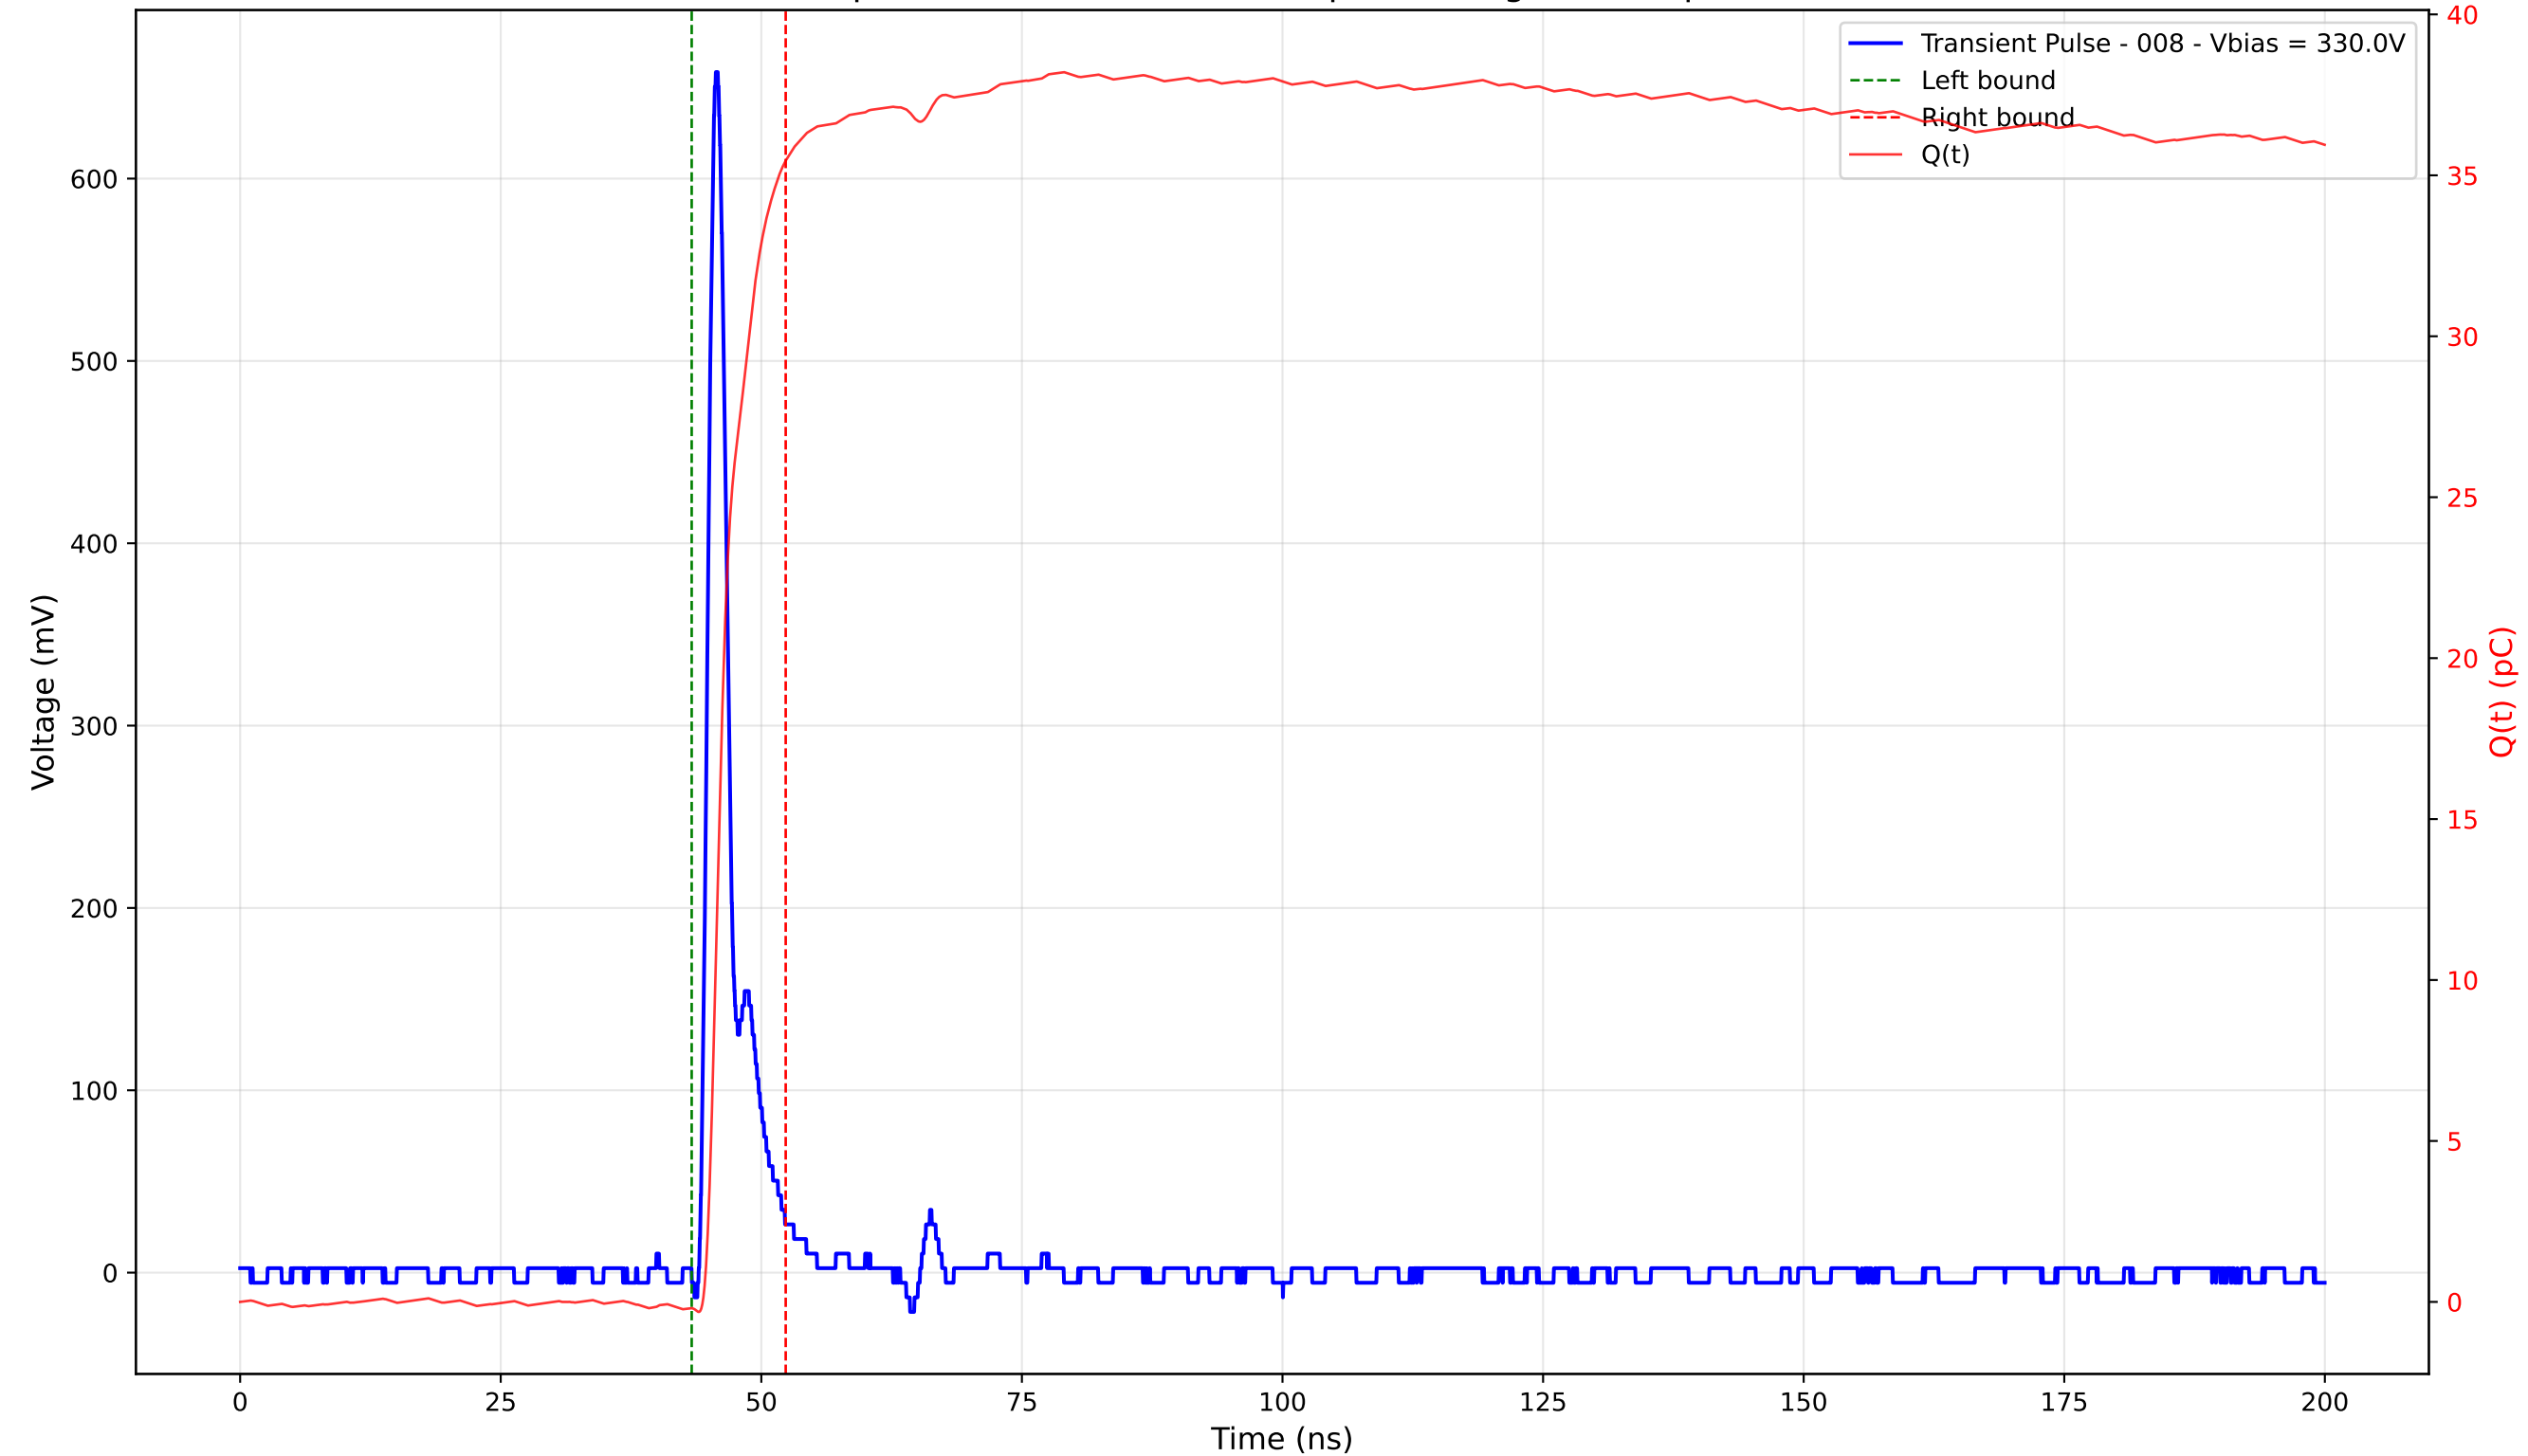


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 35.23 pC - Rise Time: 1.06 ns

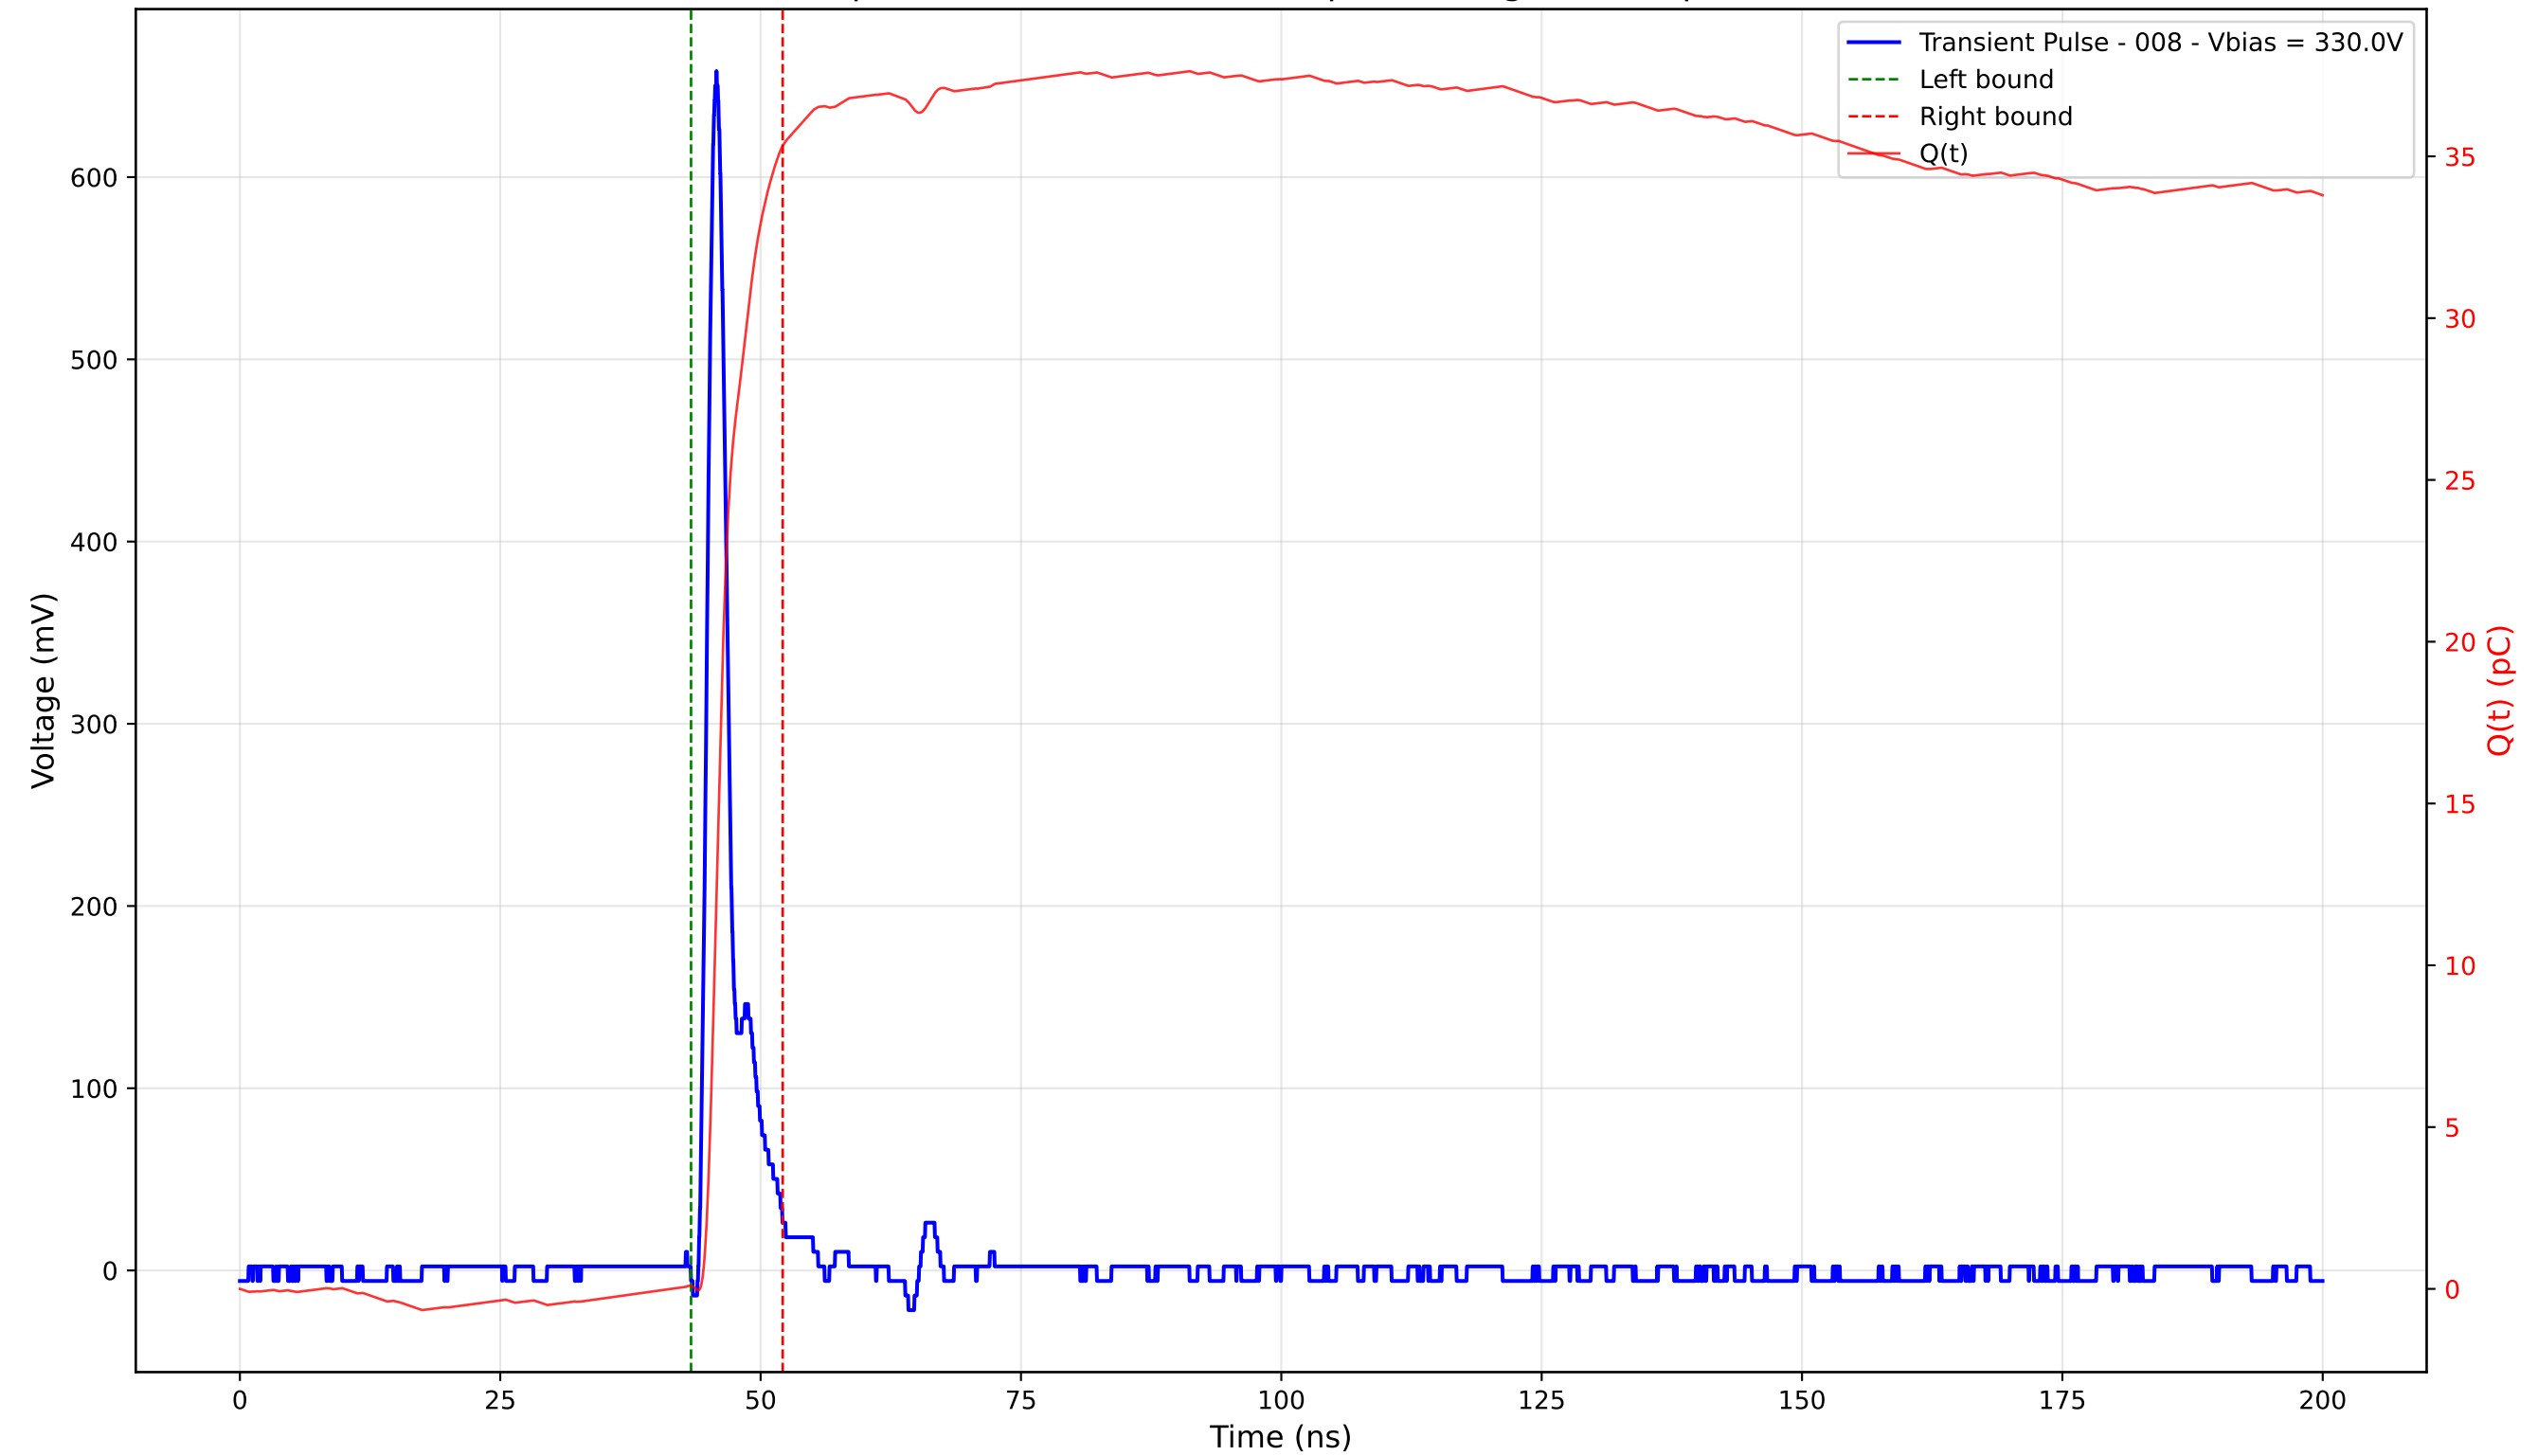


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 35.16 pC - Rise Time: 1.04 ns

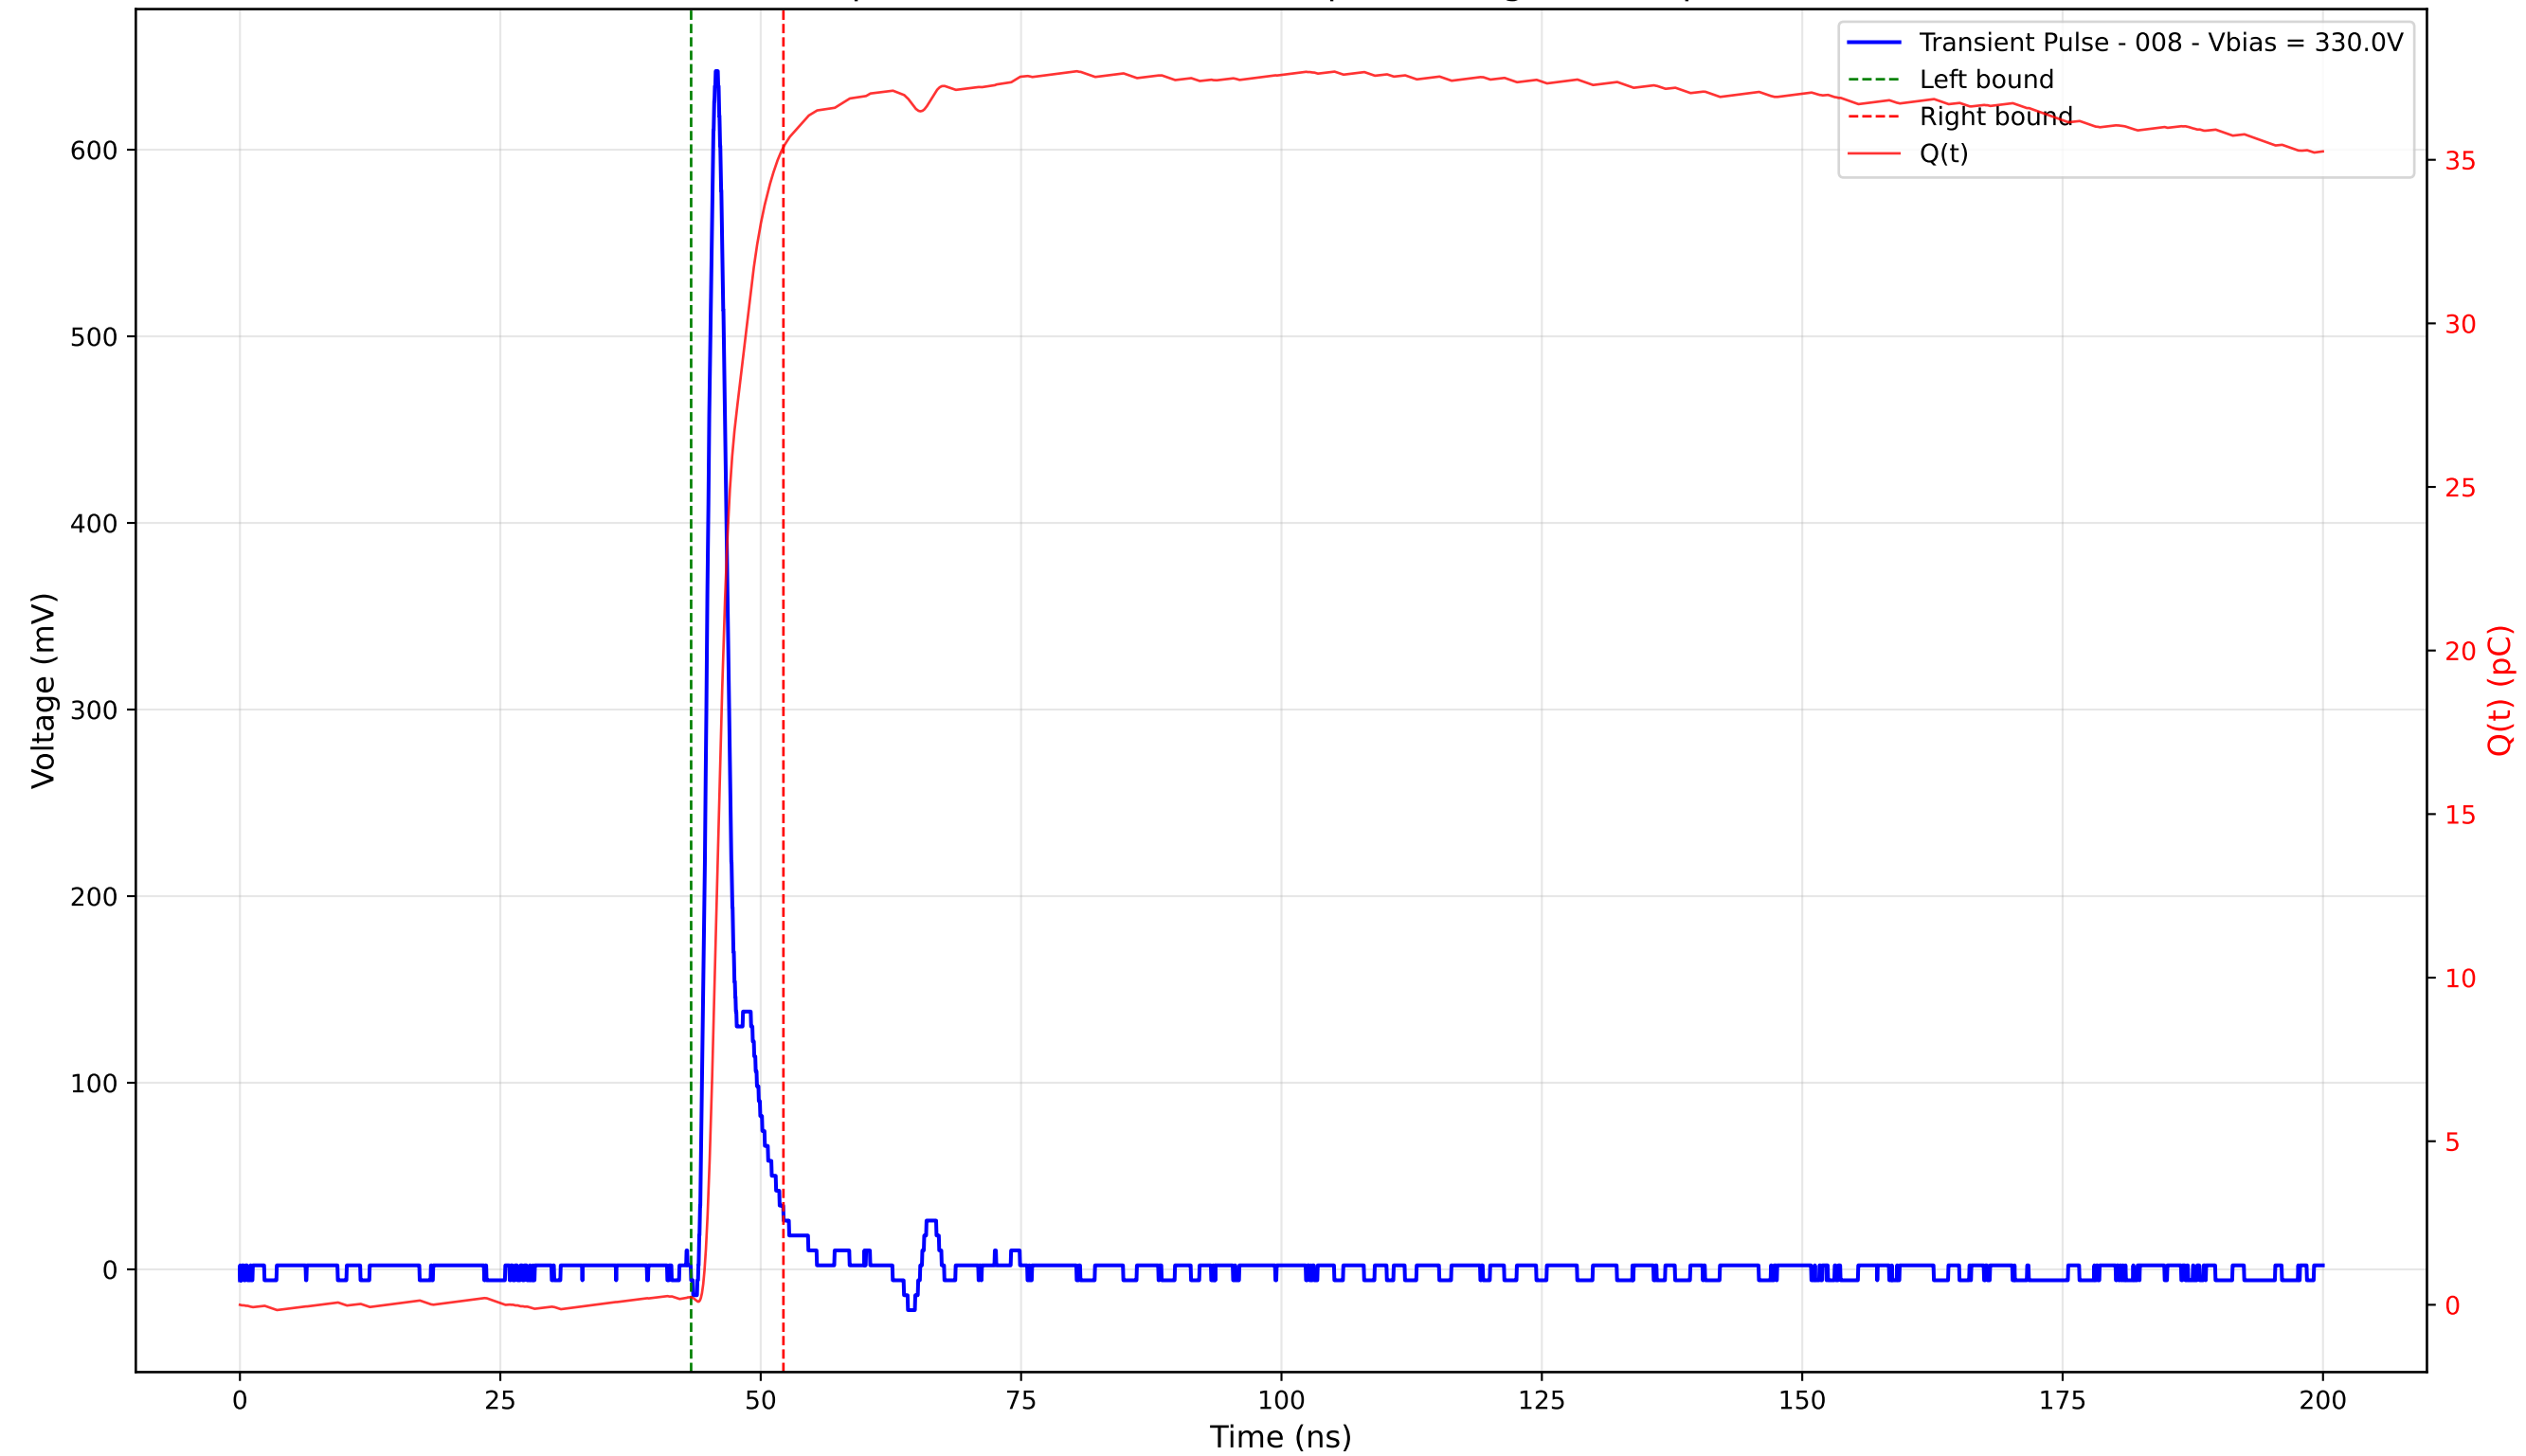


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 35.16 pC - Rise Time: 1.07 ns

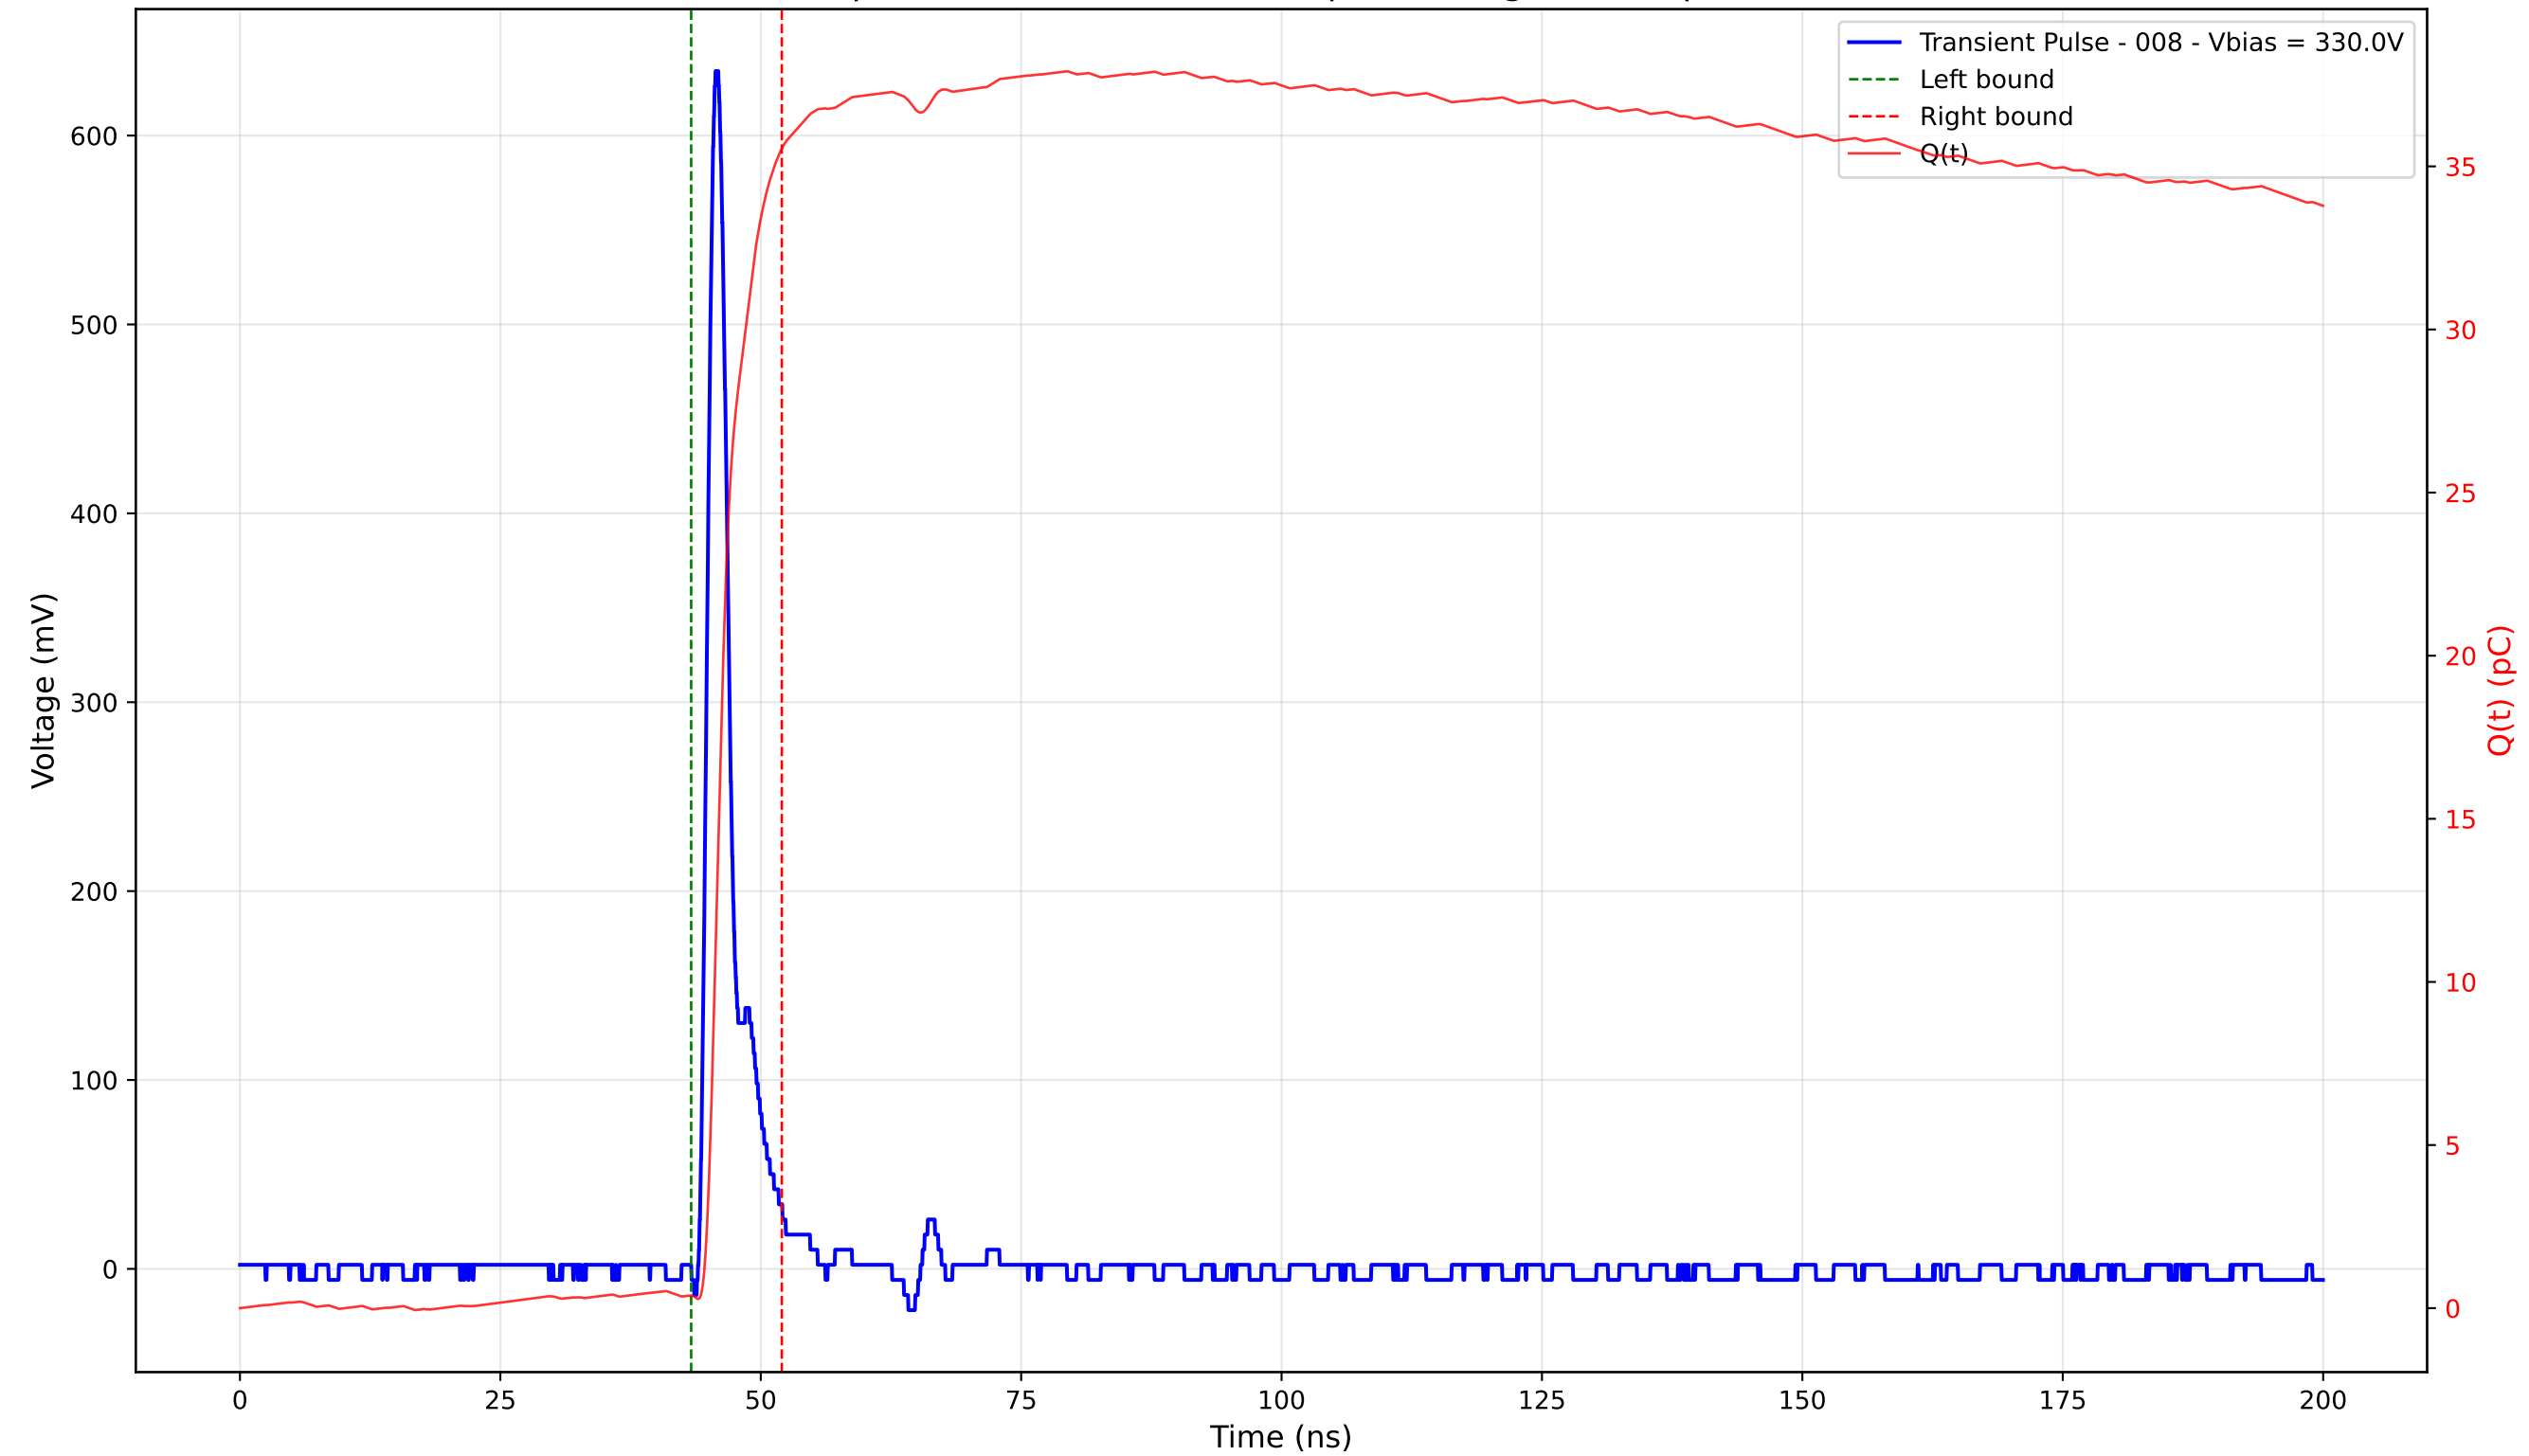


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 34.39 pC - Rise Time: 1.07 ns

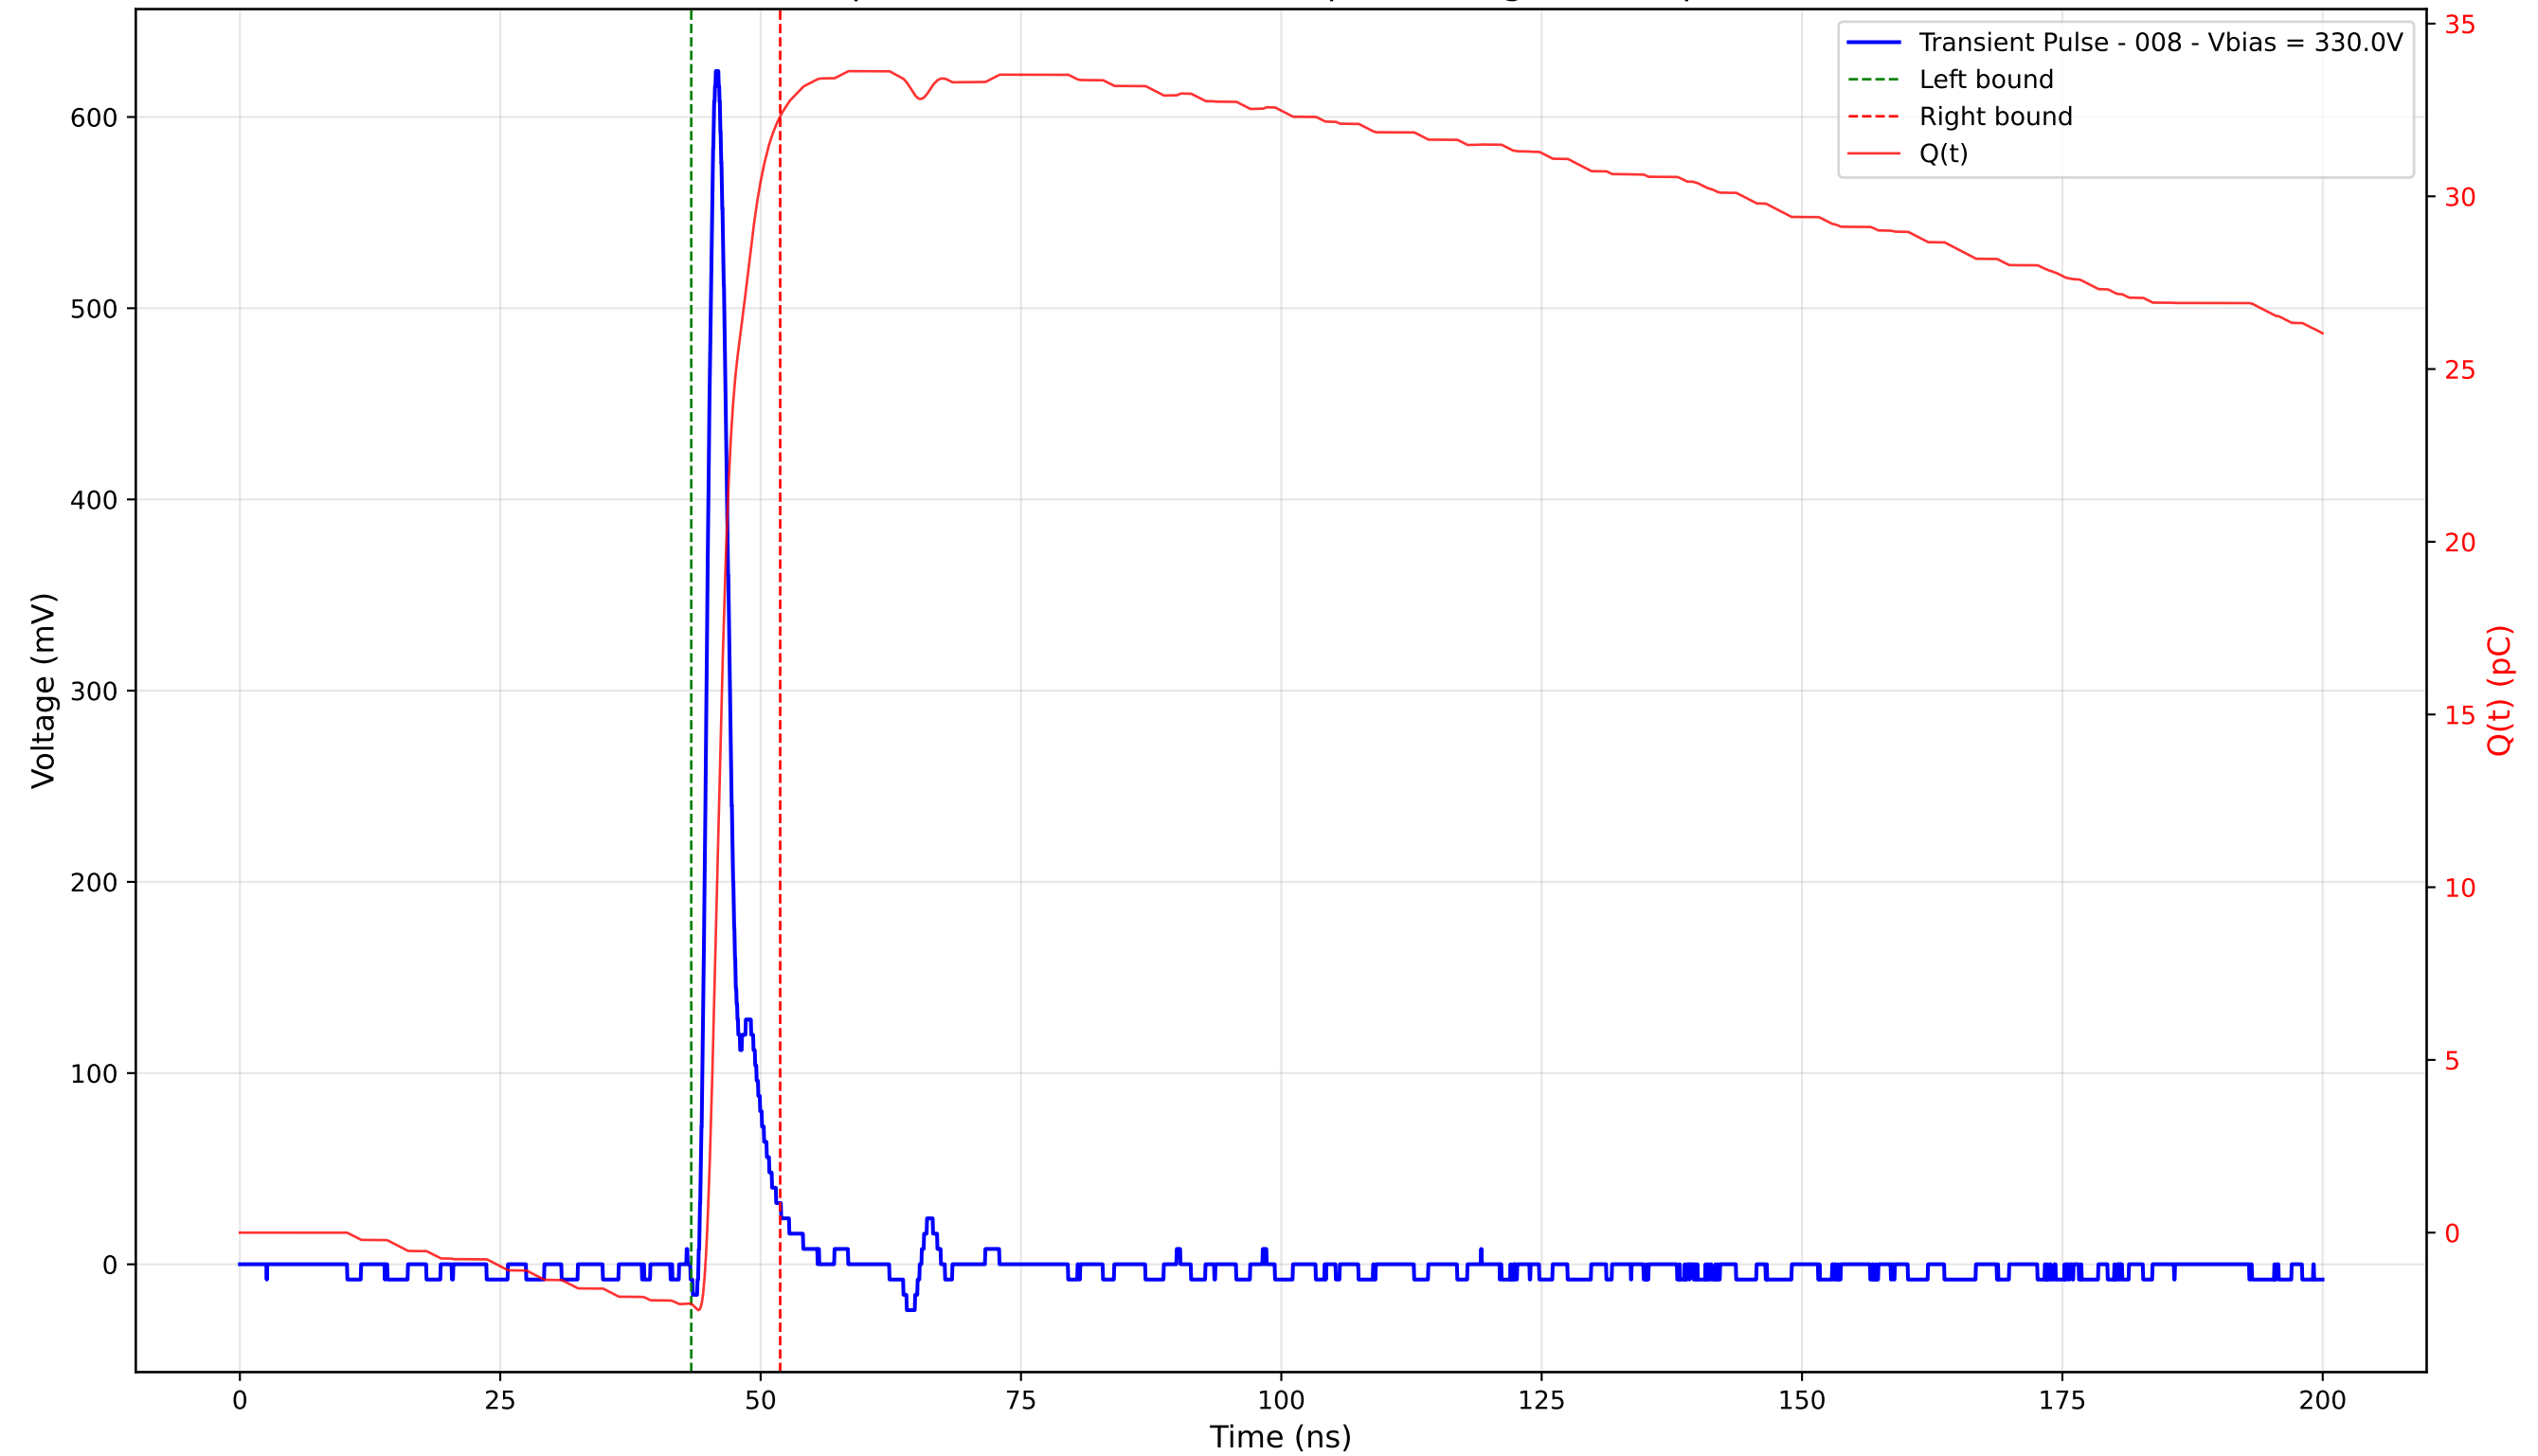


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 35.33 pC - Rise Time: 1.08 ns

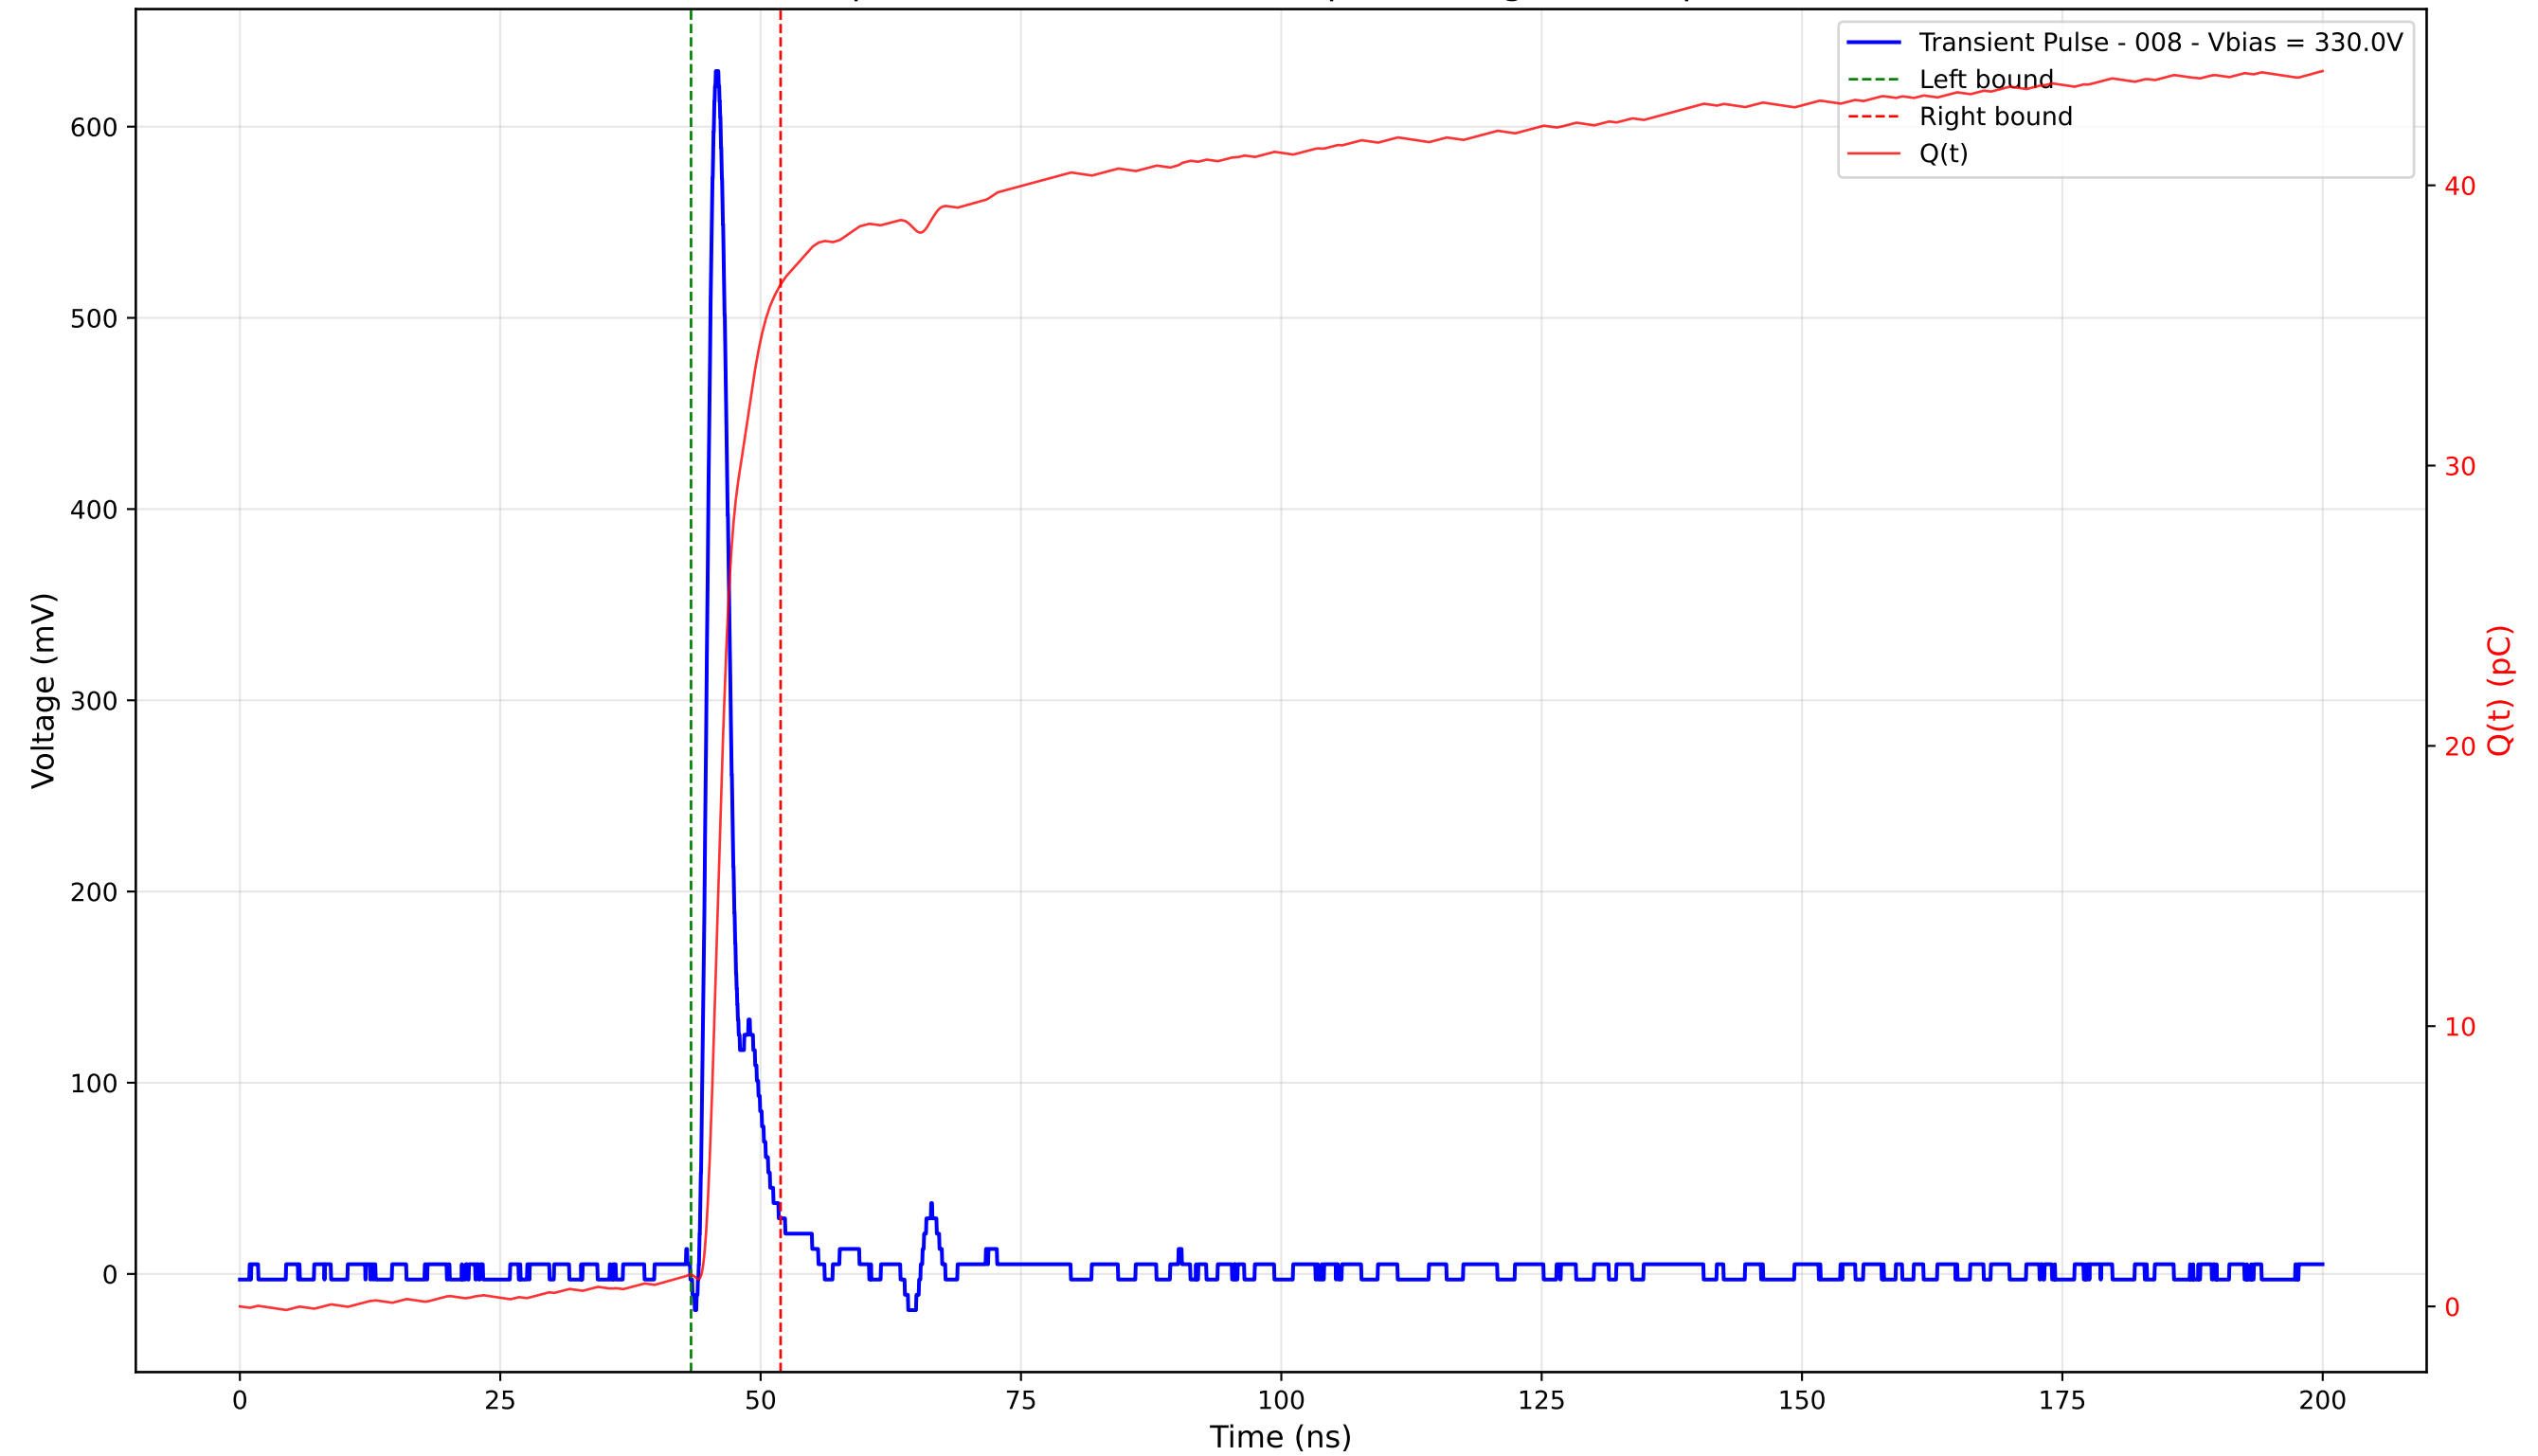


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 34.65 pC - Rise Time: 1.11 ns

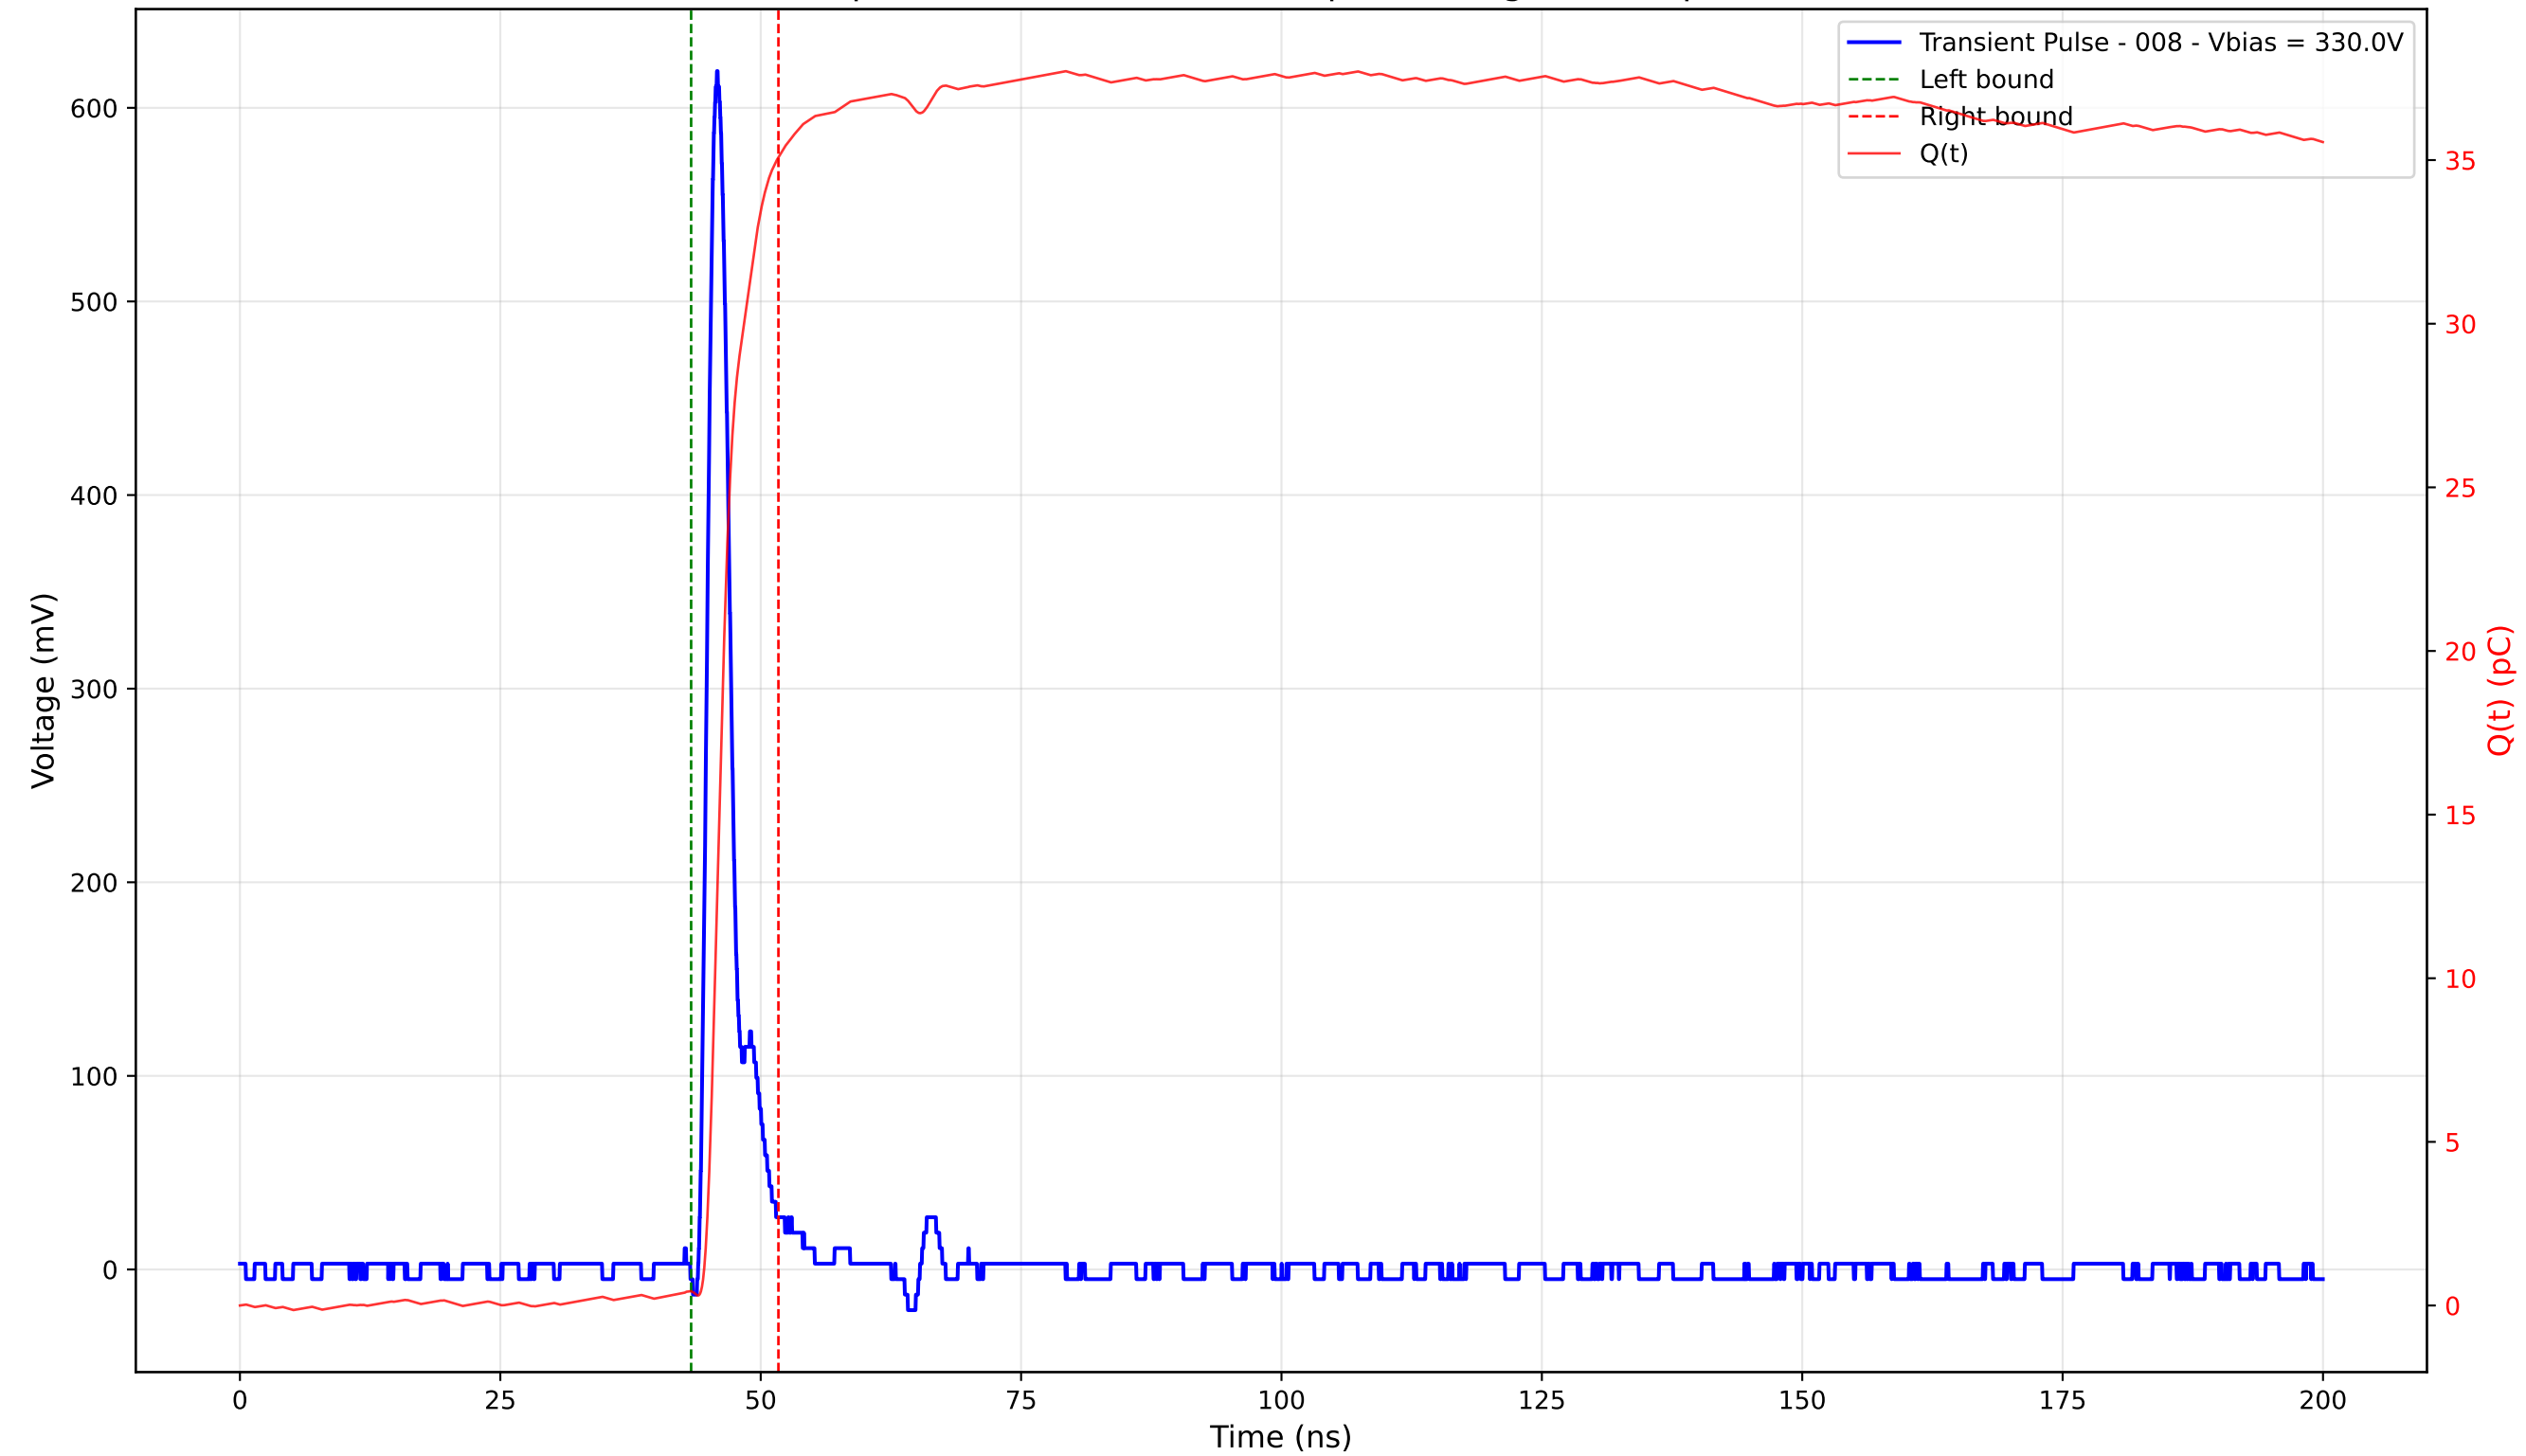


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 35.04 pC - Rise Time: 1.08 ns

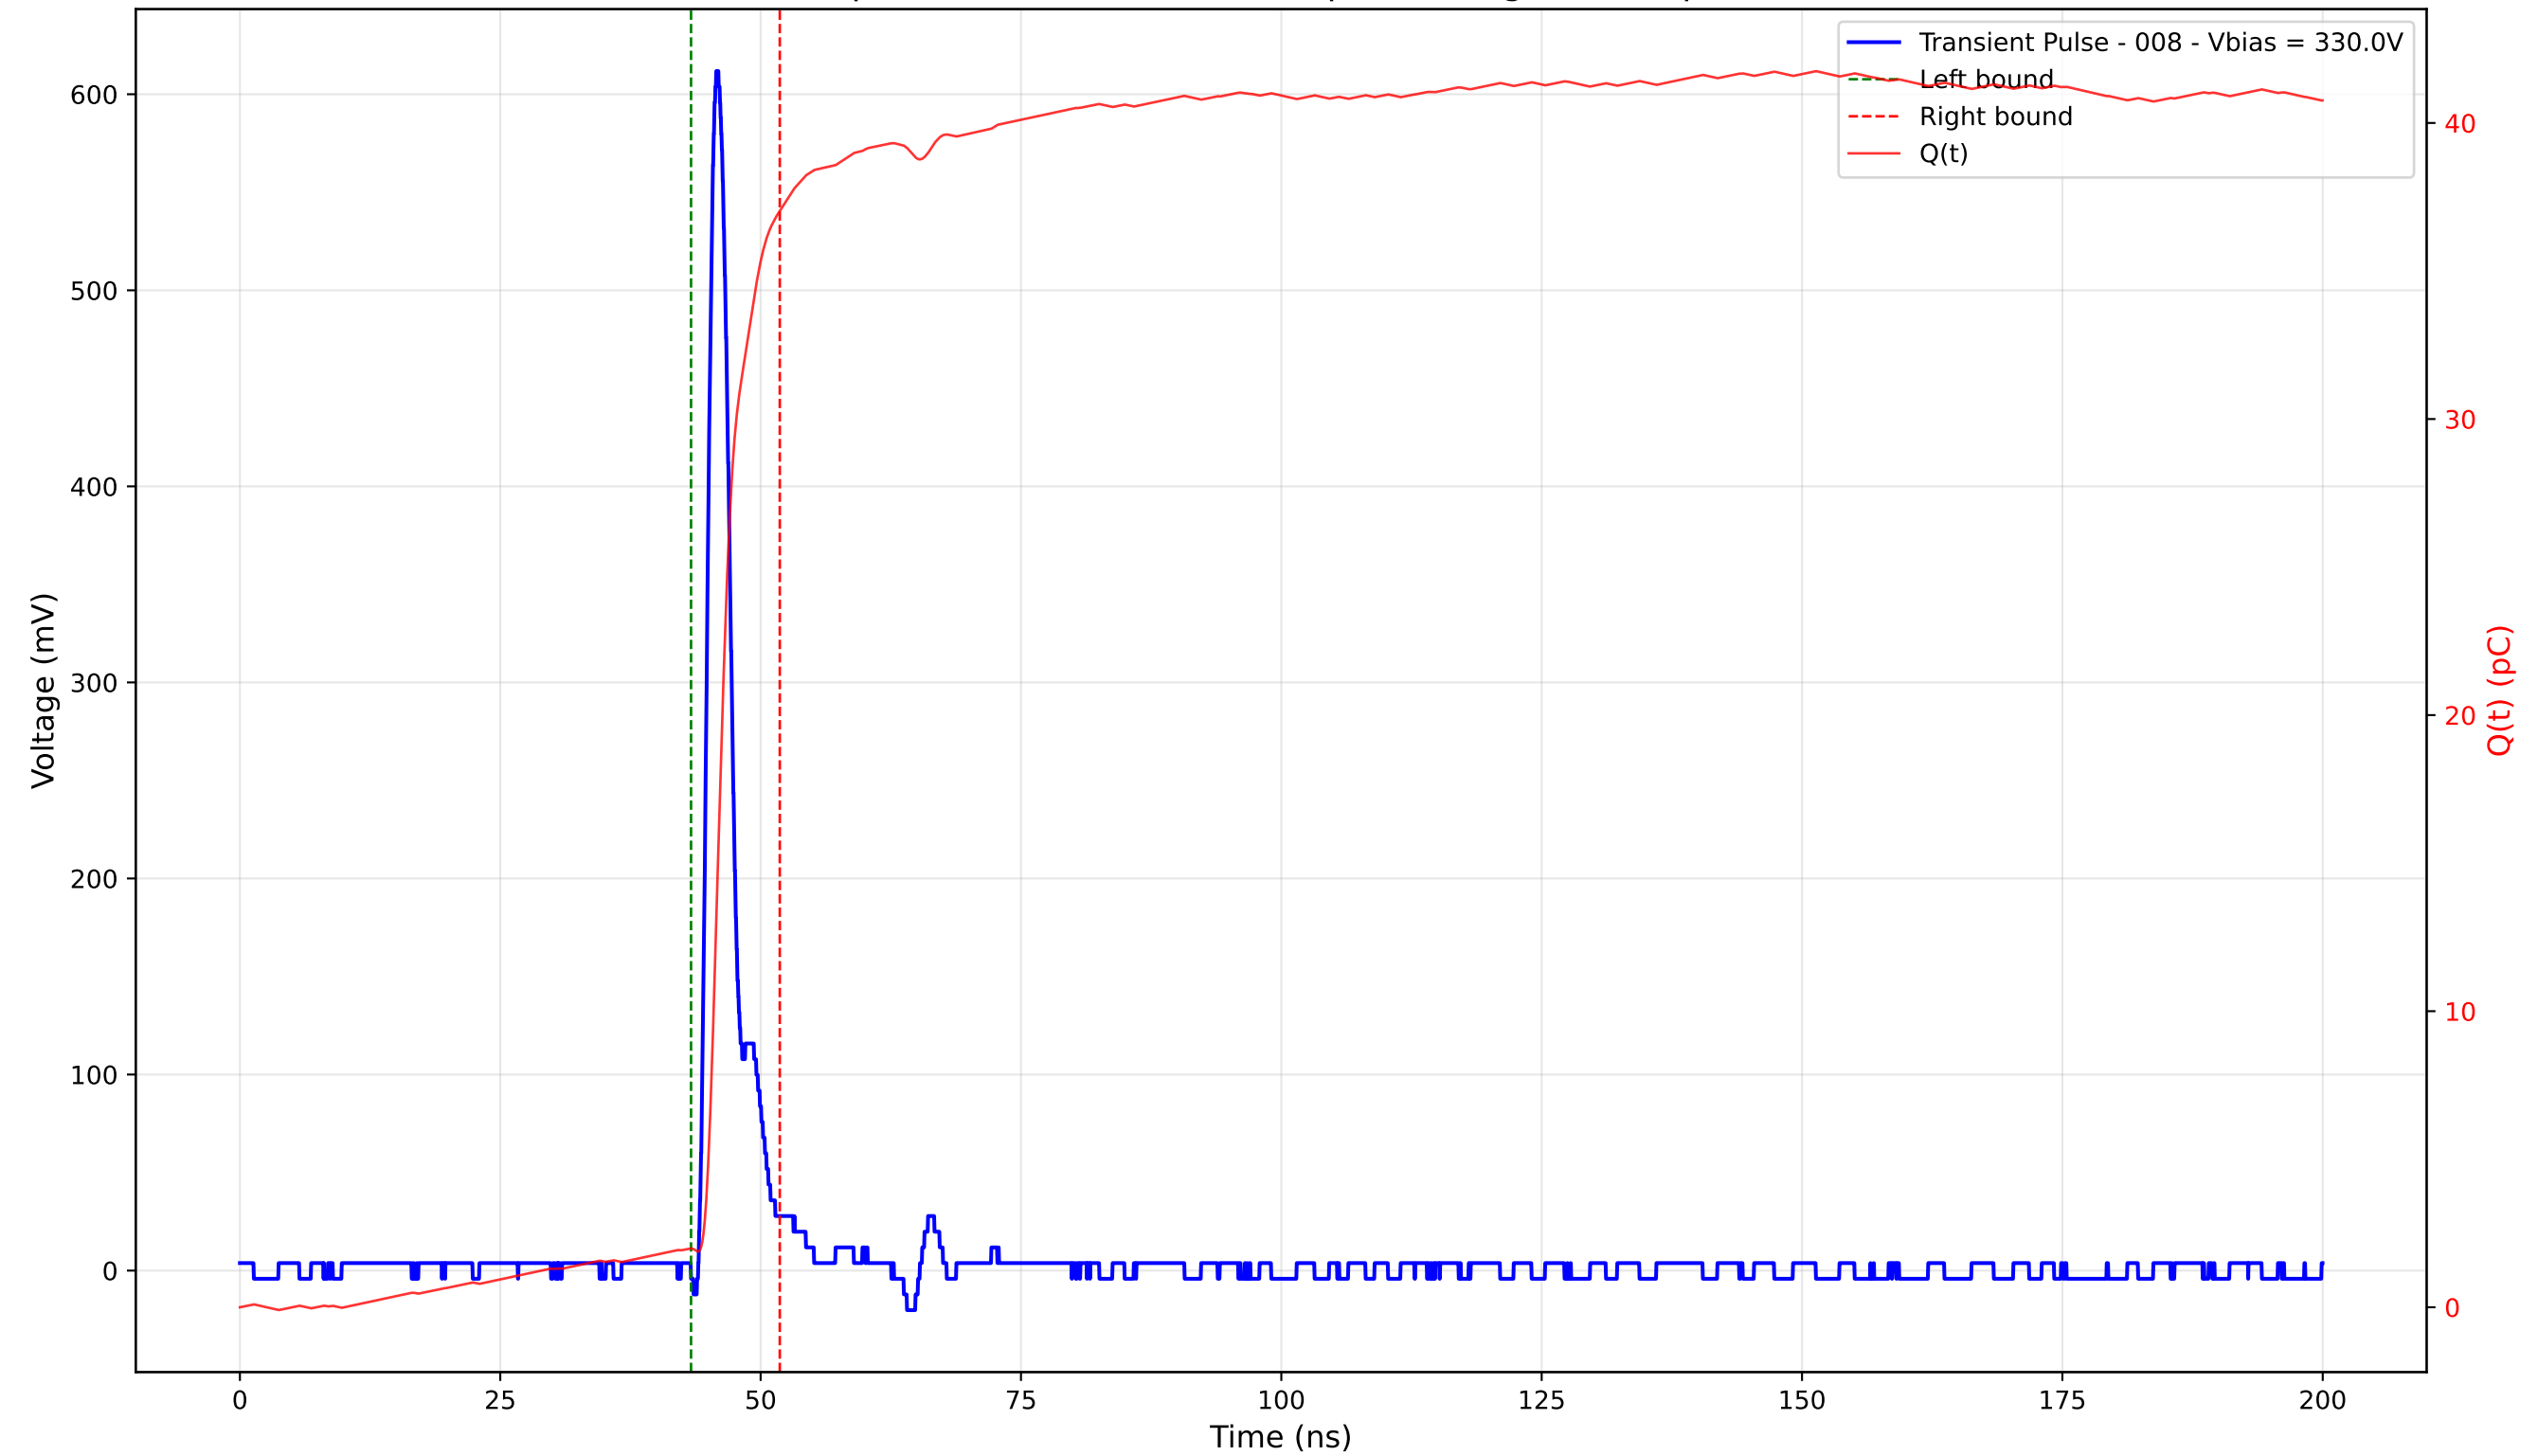


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 34.56 pC - Rise Time: 1.10 ns

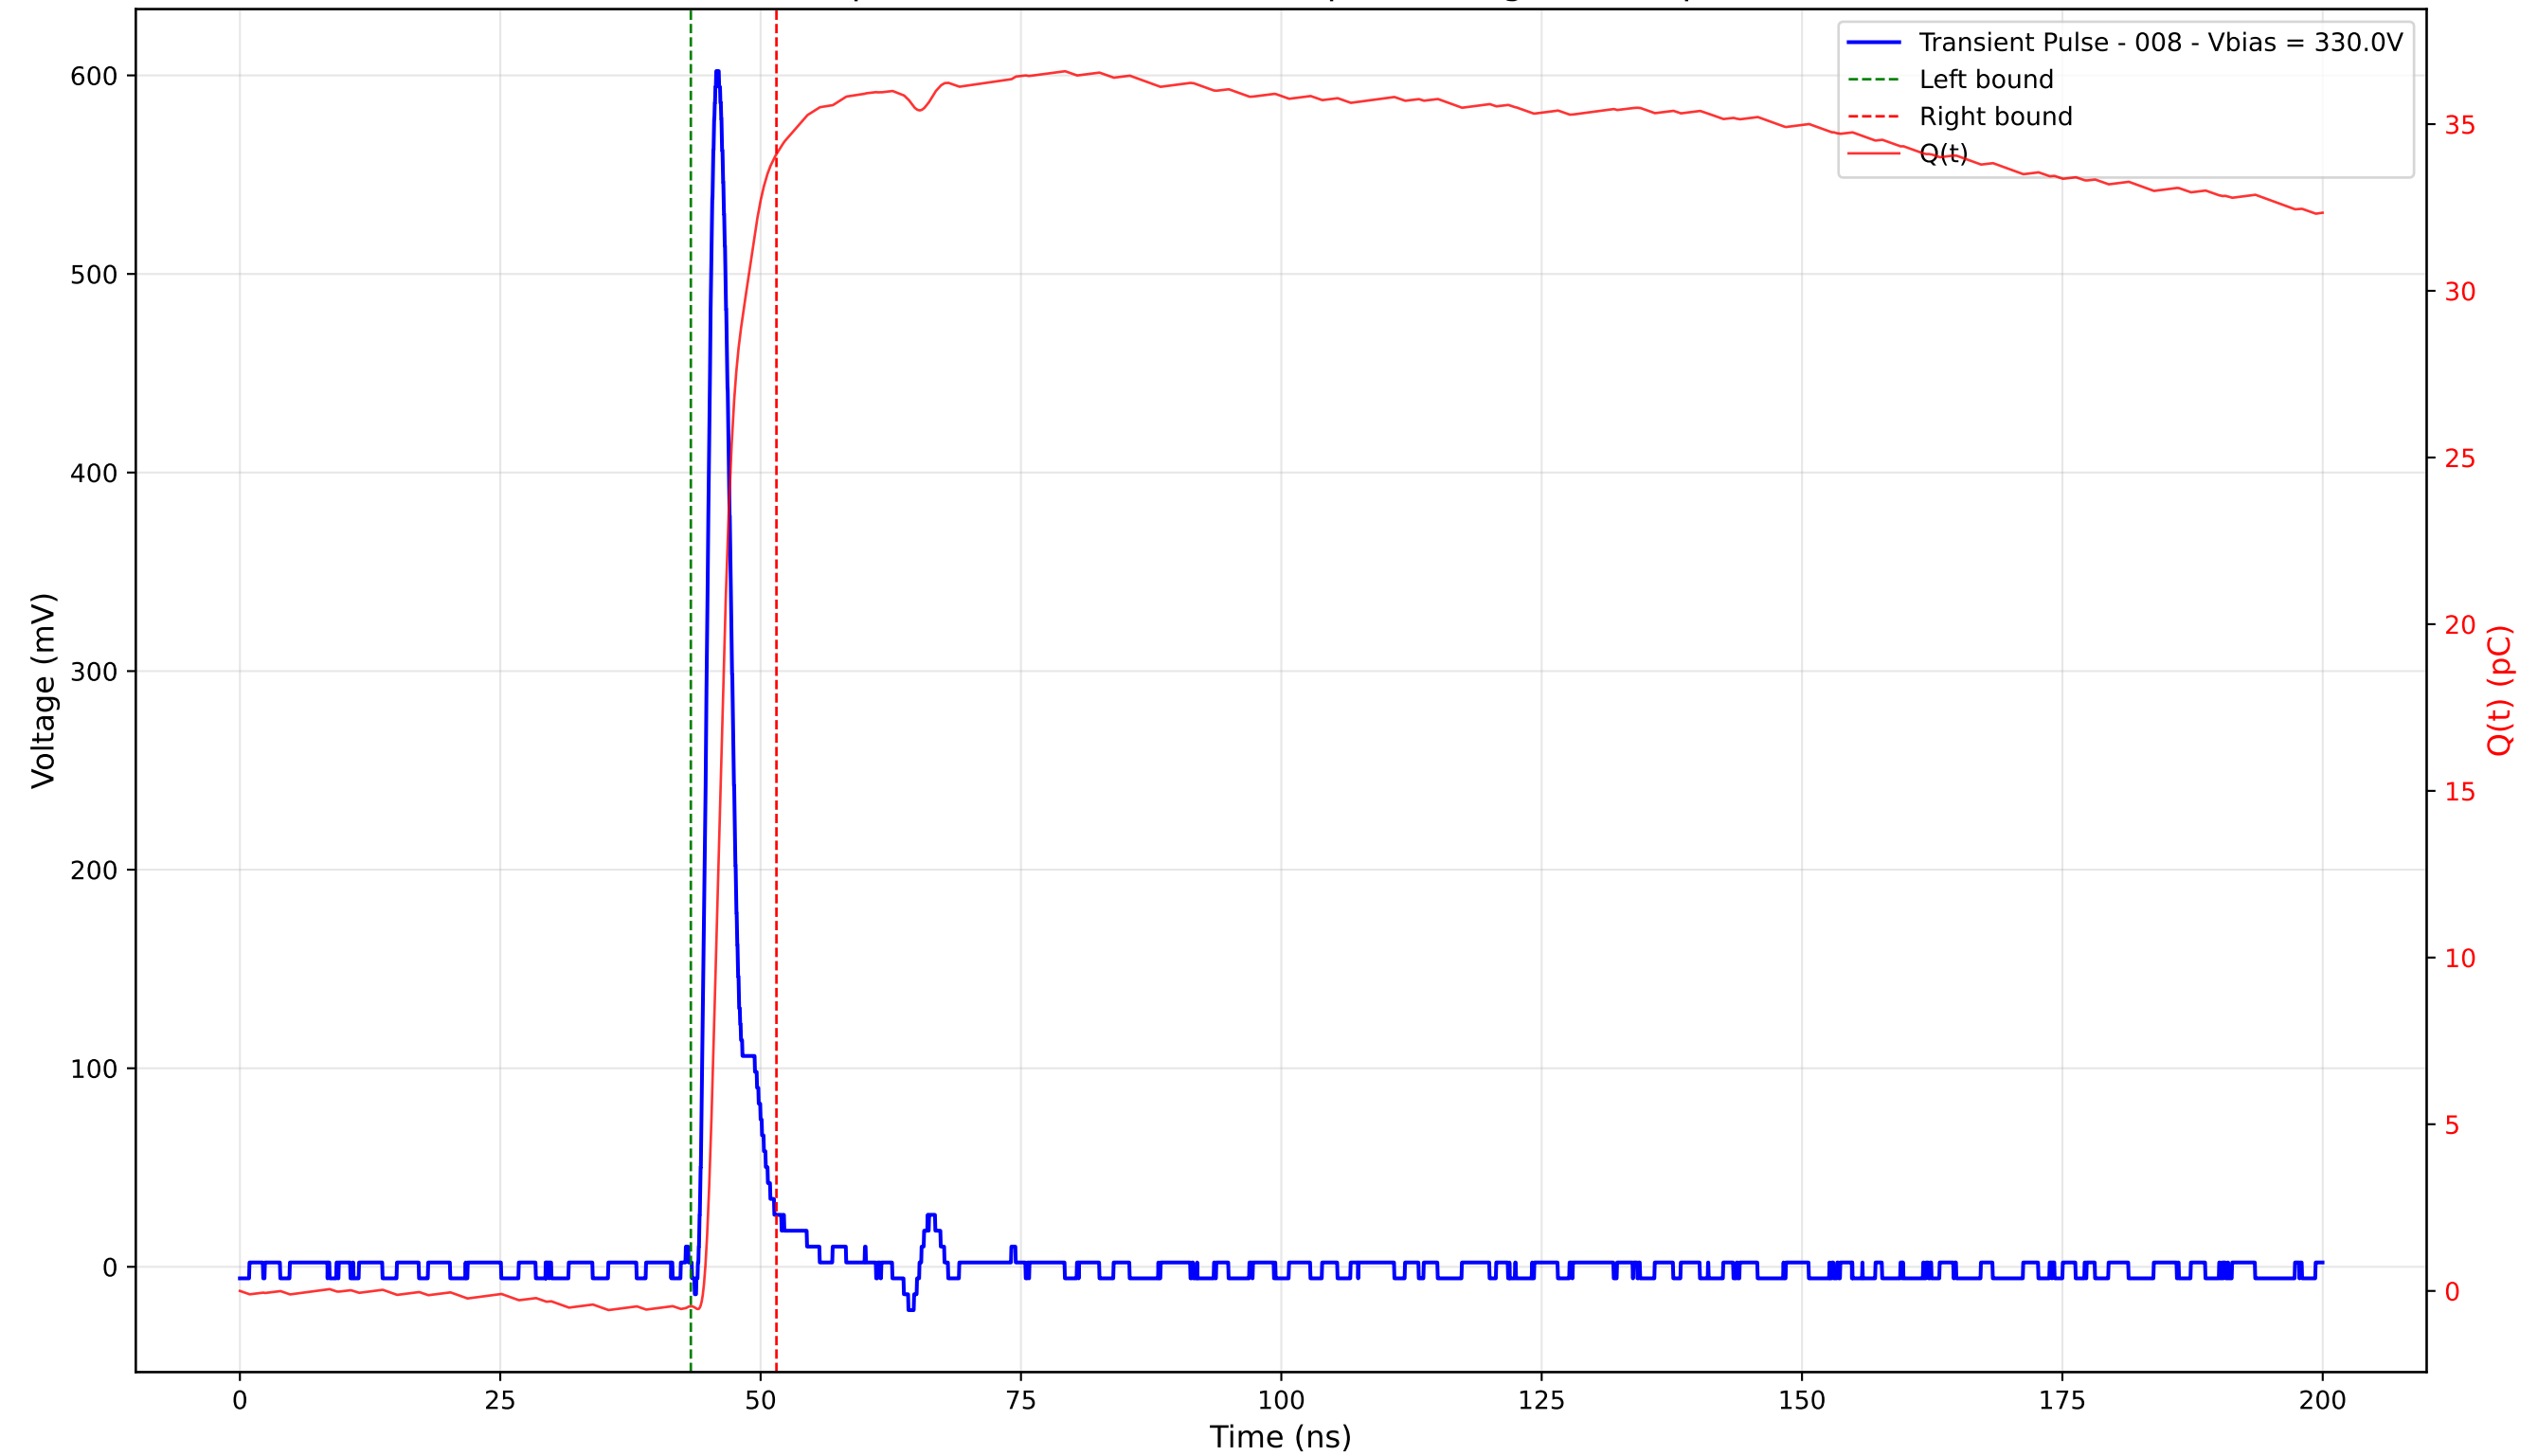


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 34.36 pC - Rise Time: 1.09 ns

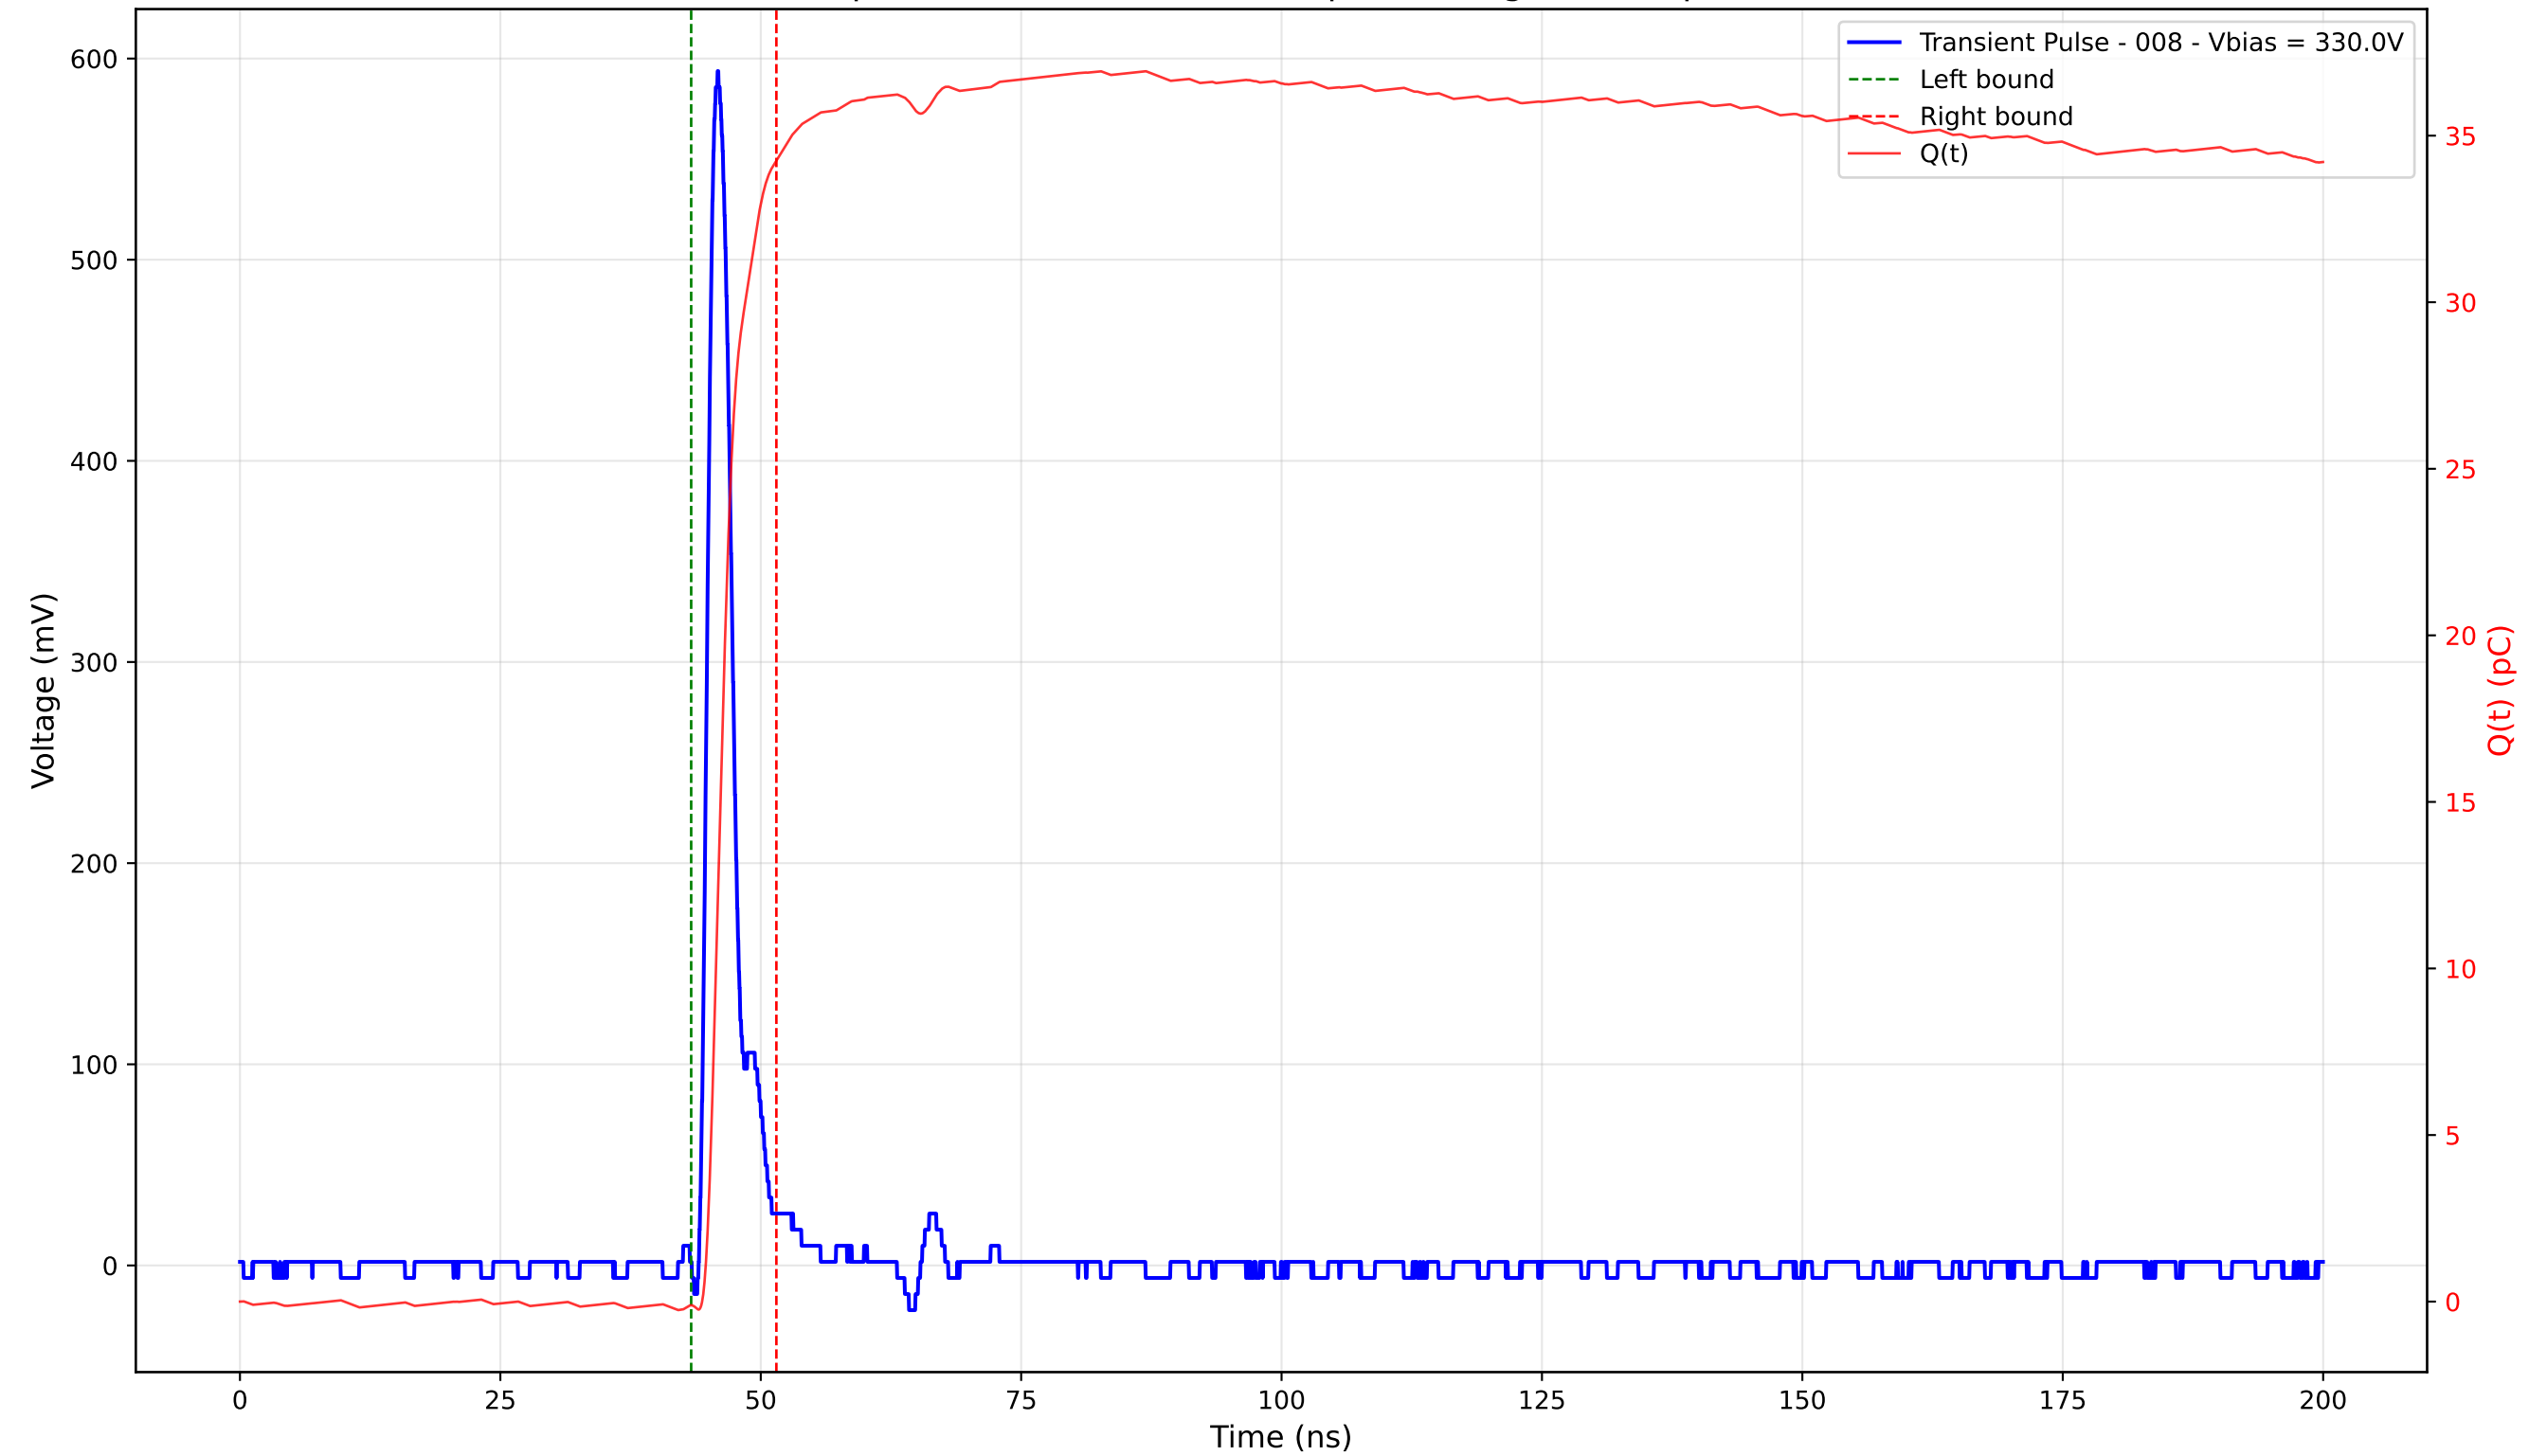


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 33.99 pC - Rise Time: 1.08 ns

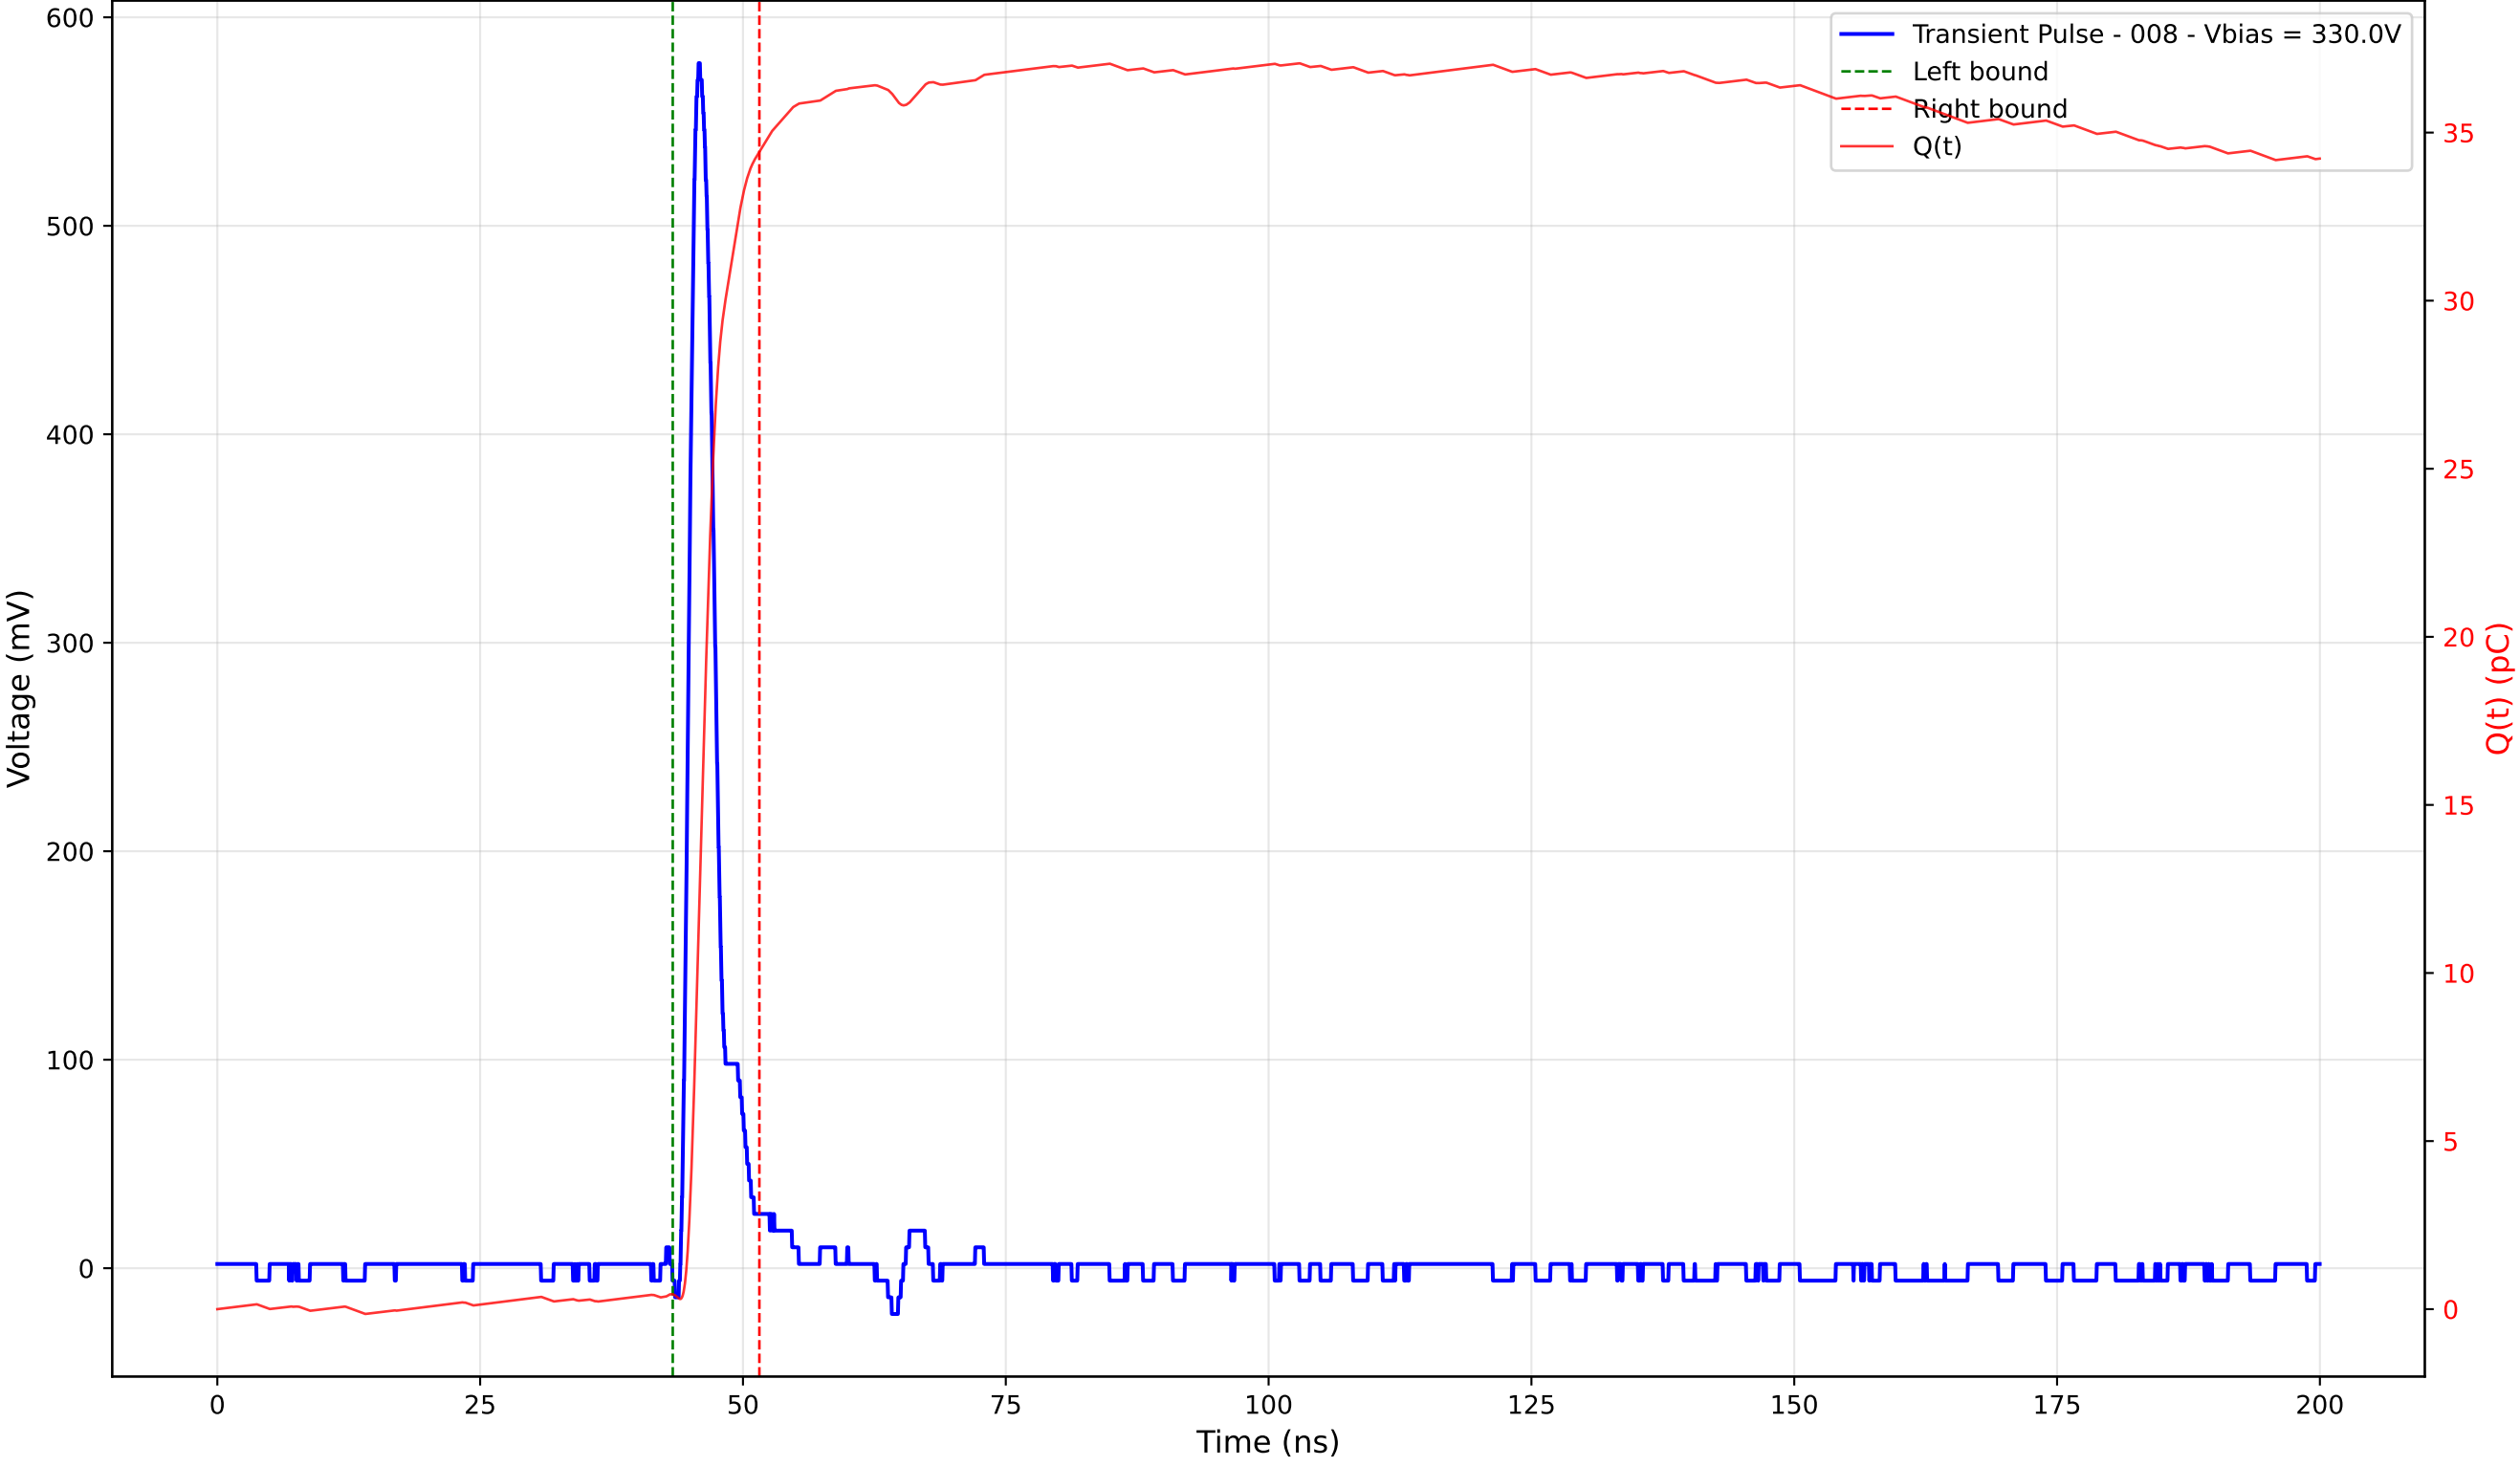


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 33.90 pC - Rise Time: 1.07 ns

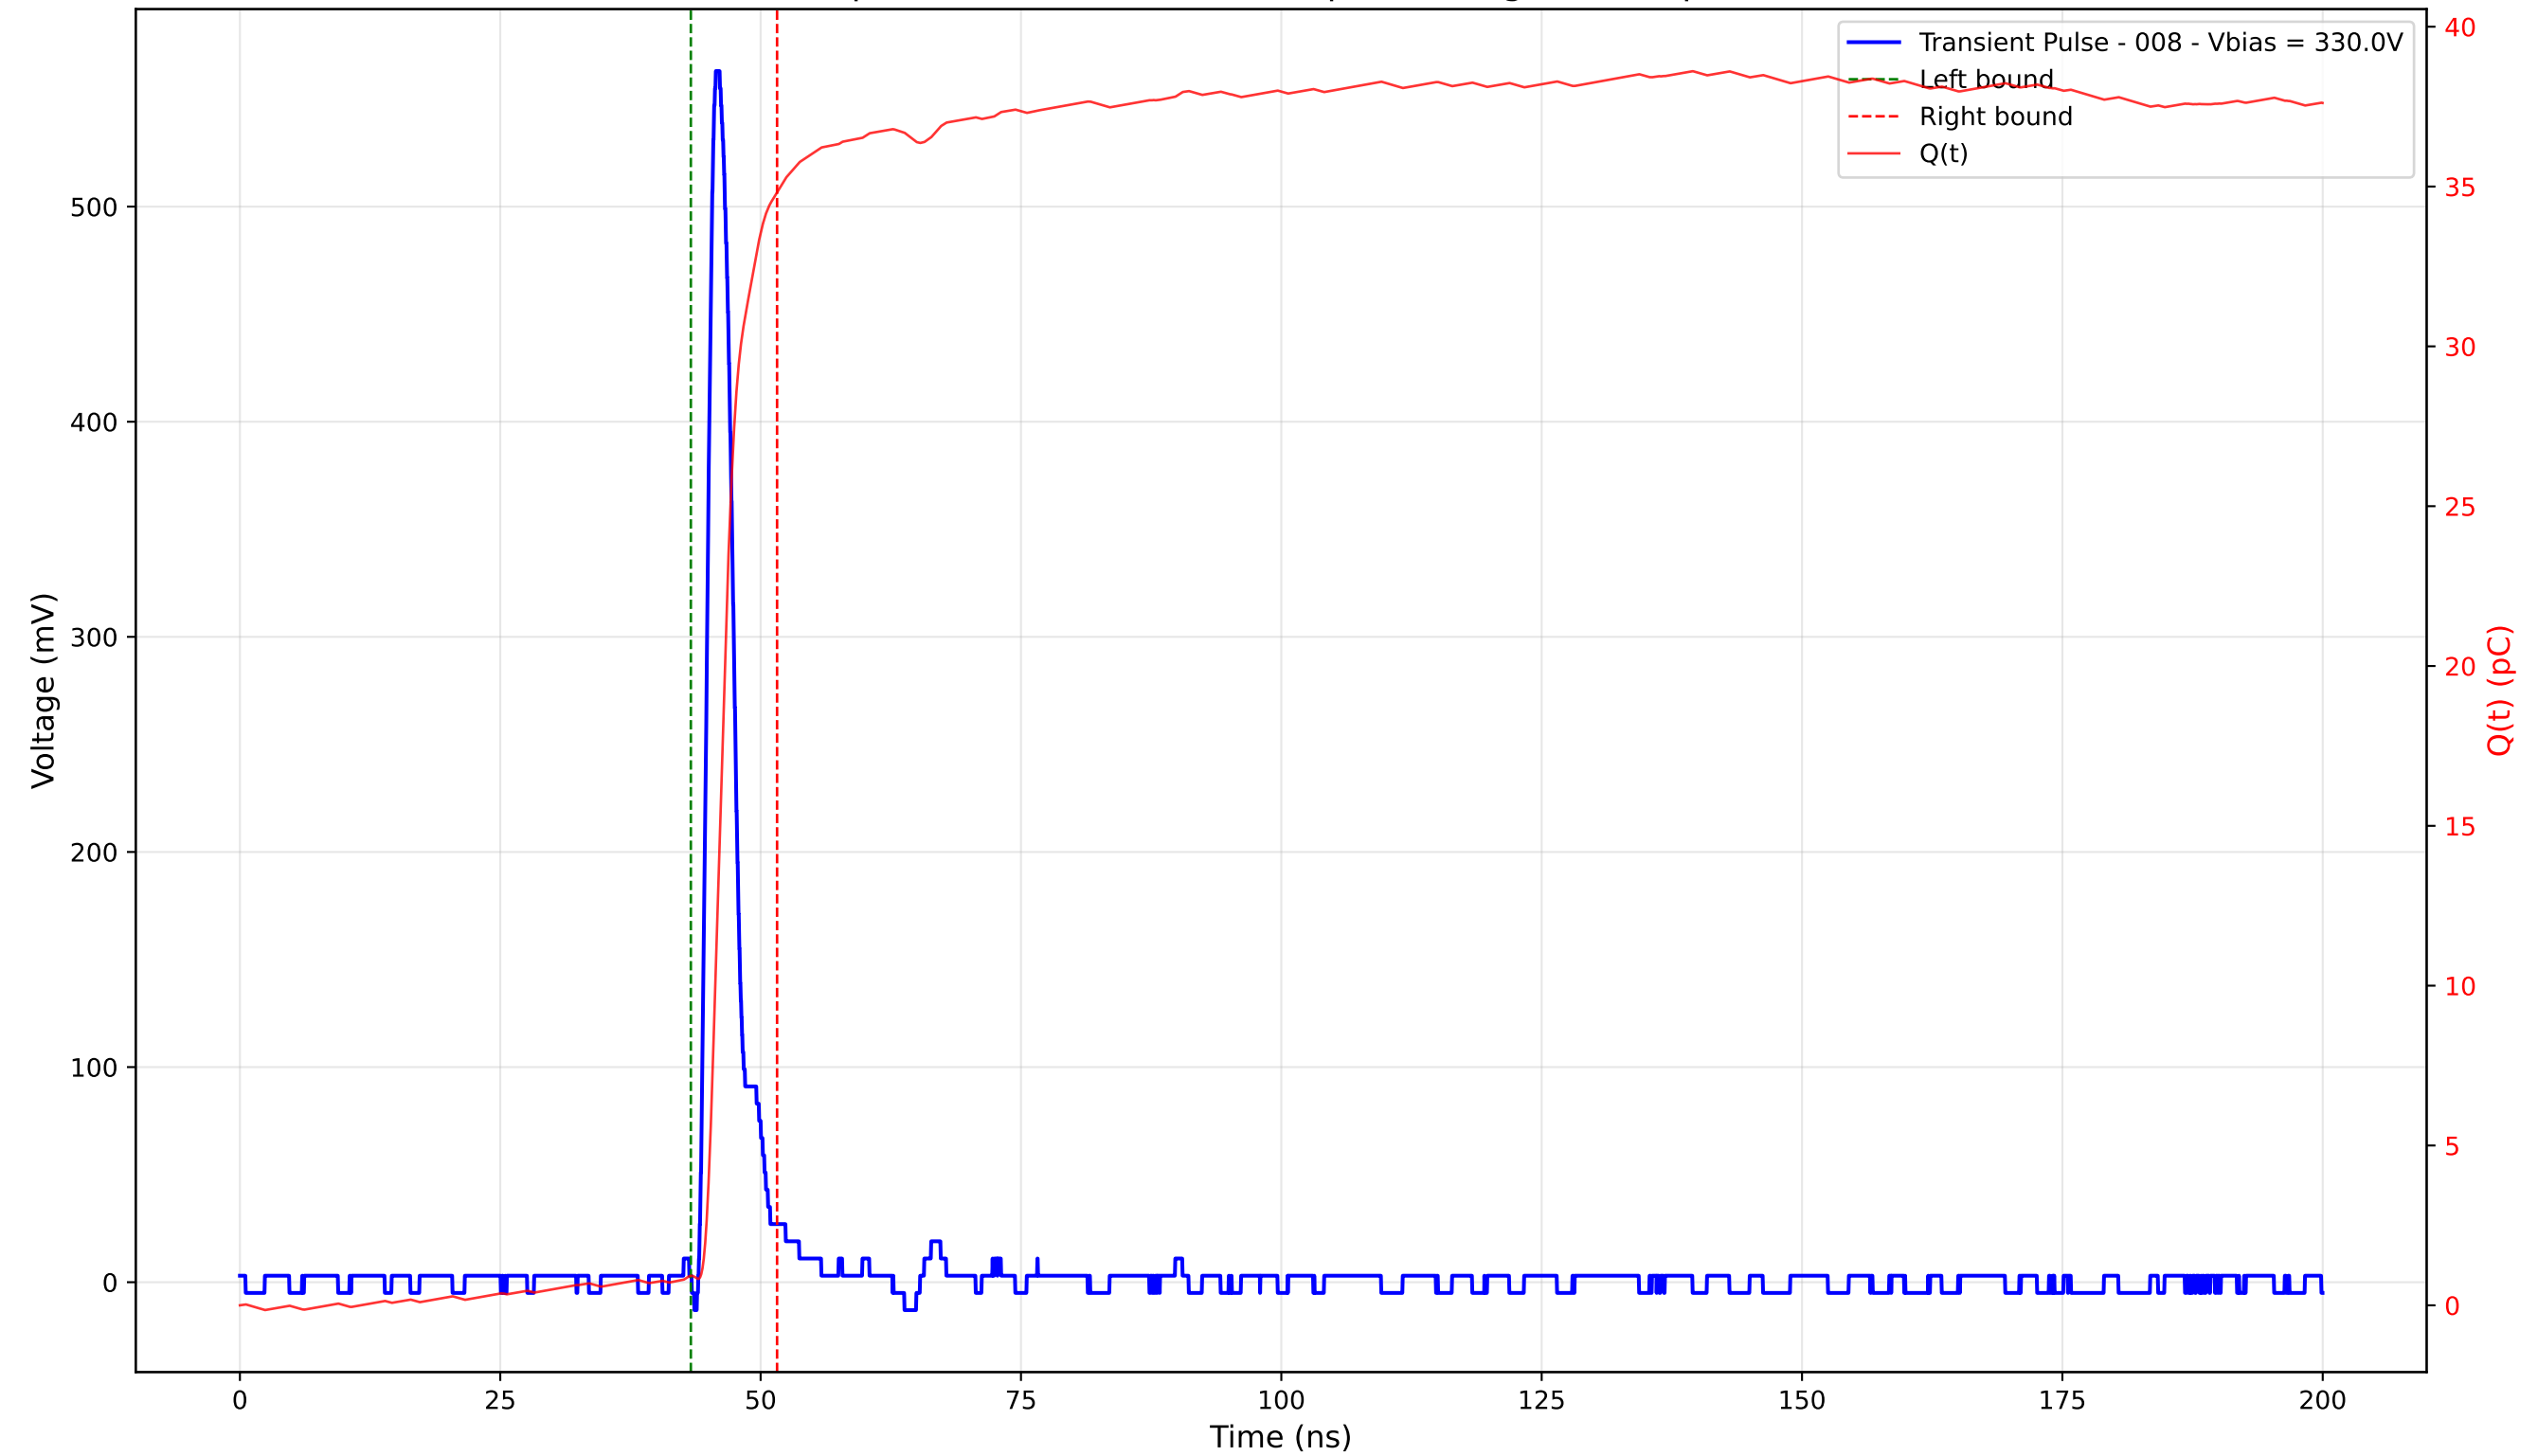


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 33.89 pC - Rise Time: 1.09 ns

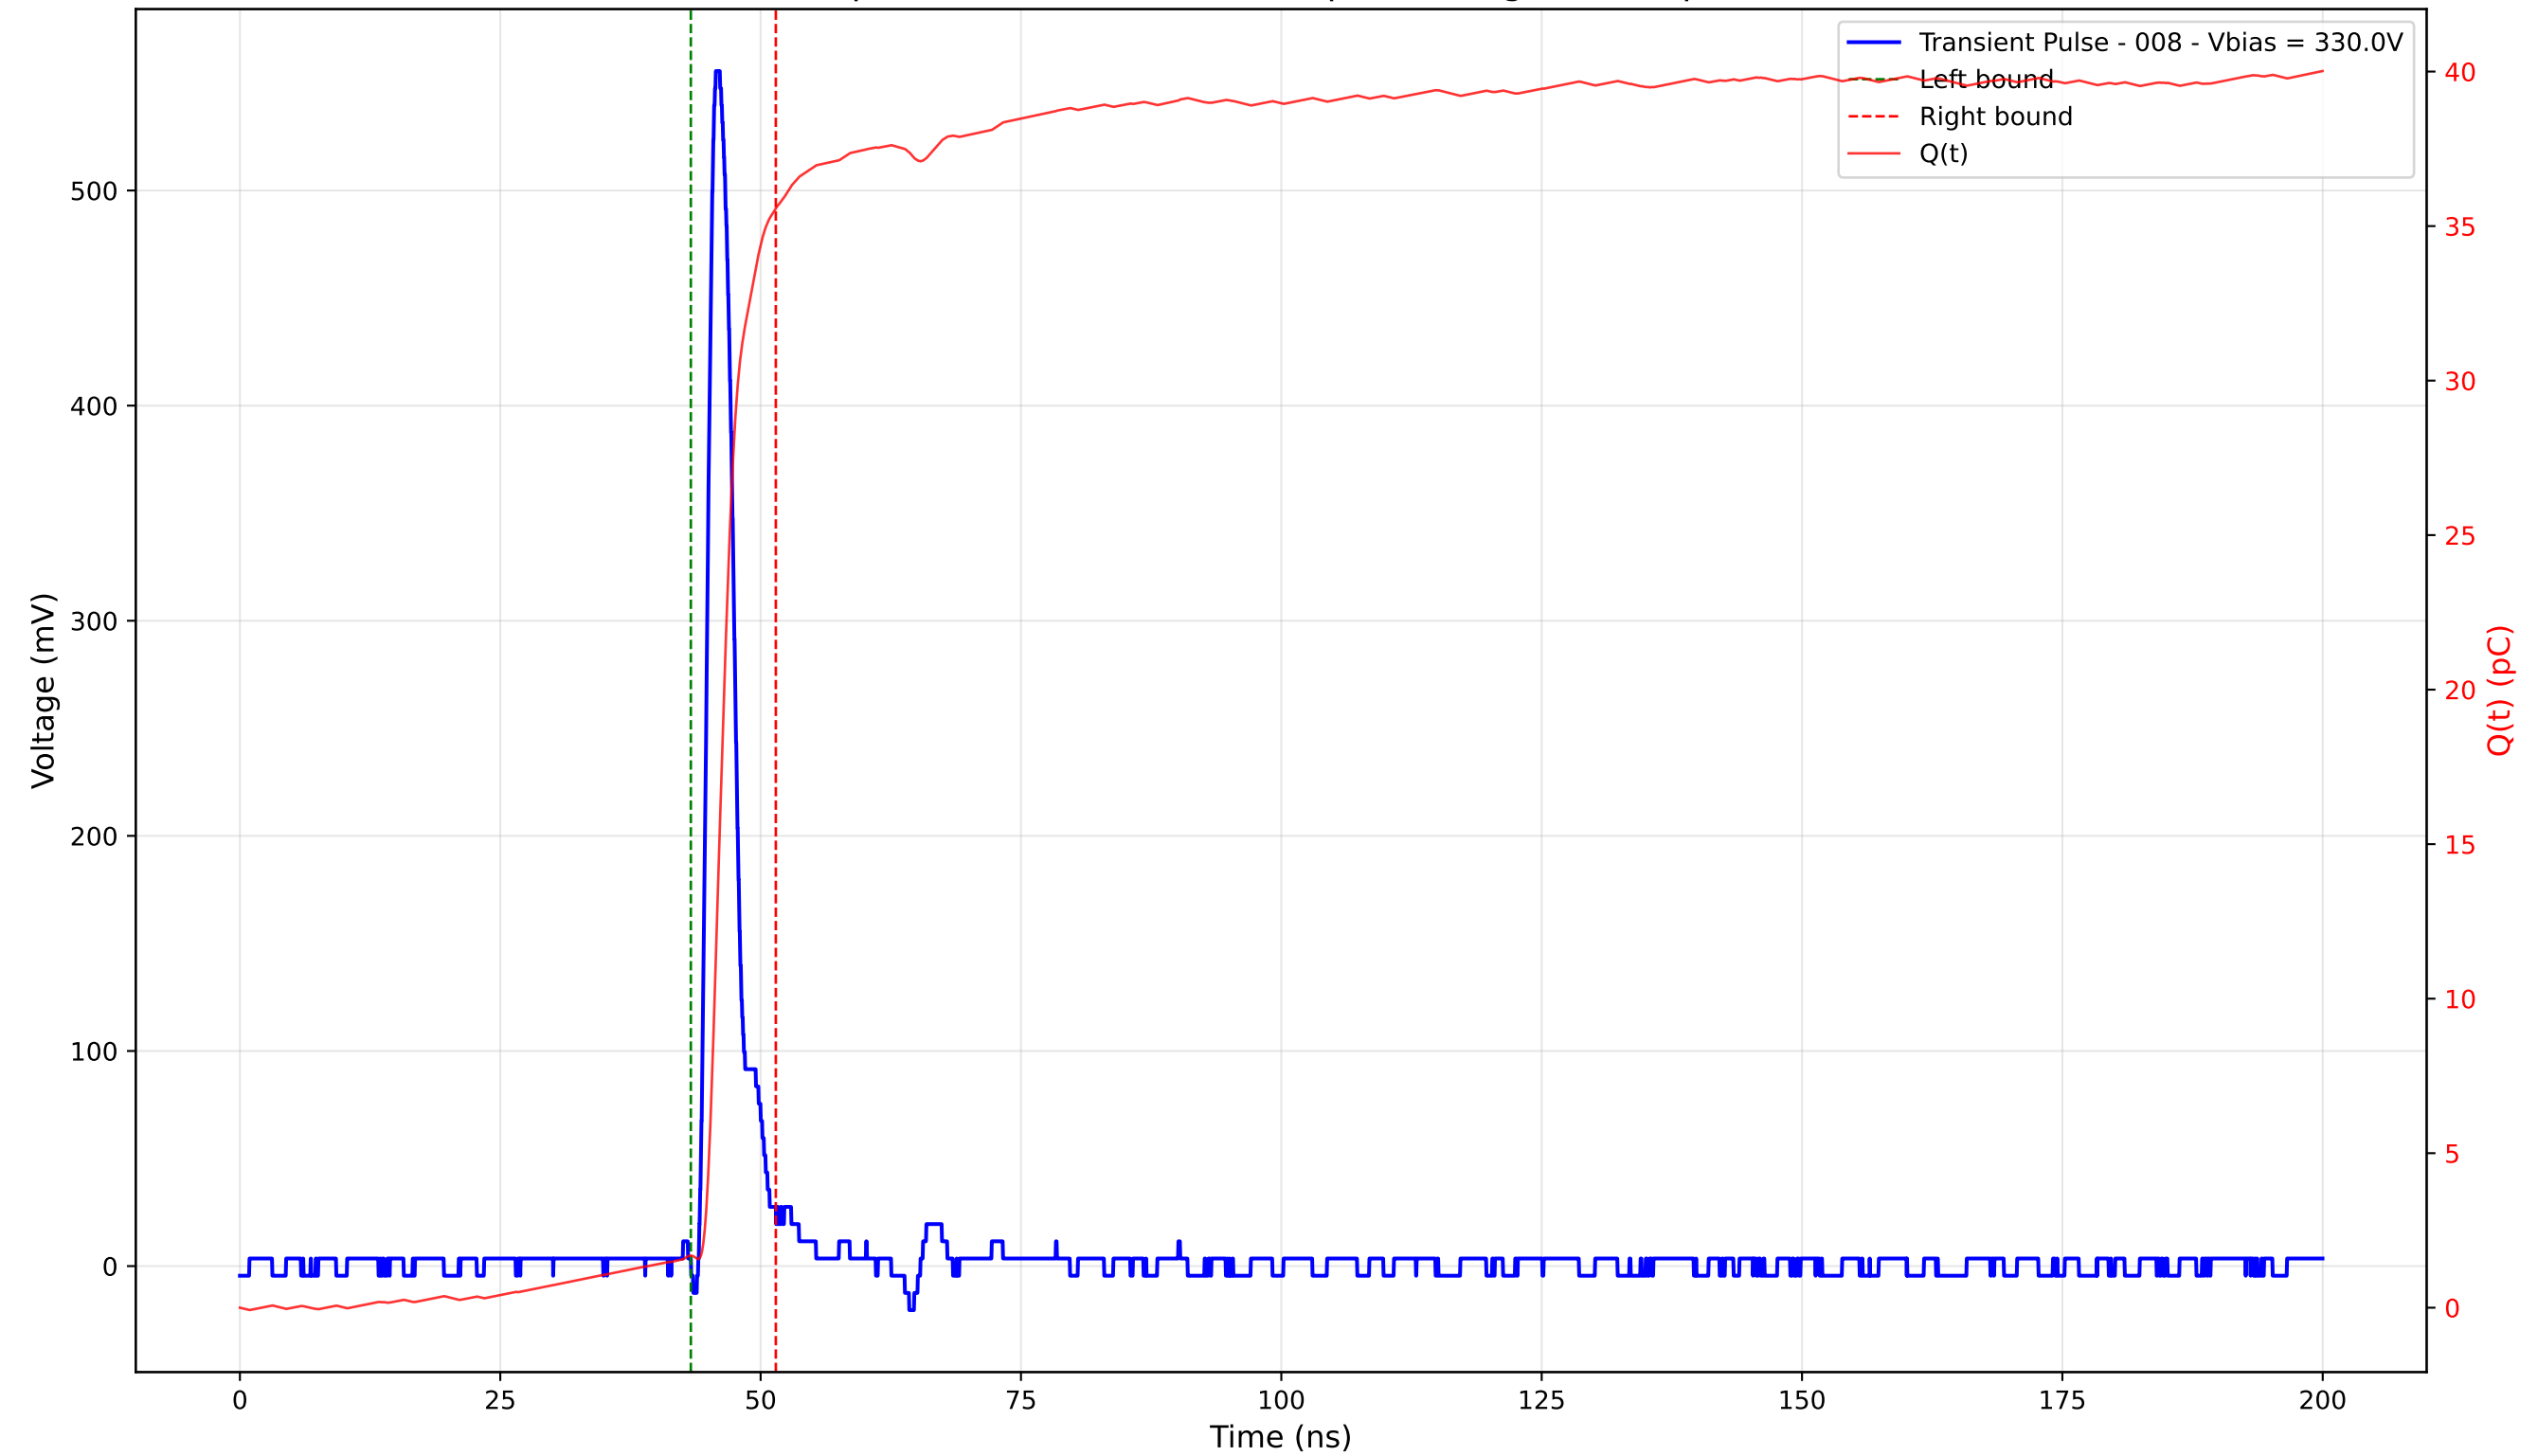


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 33.29 pC - Rise Time: 1.09 ns

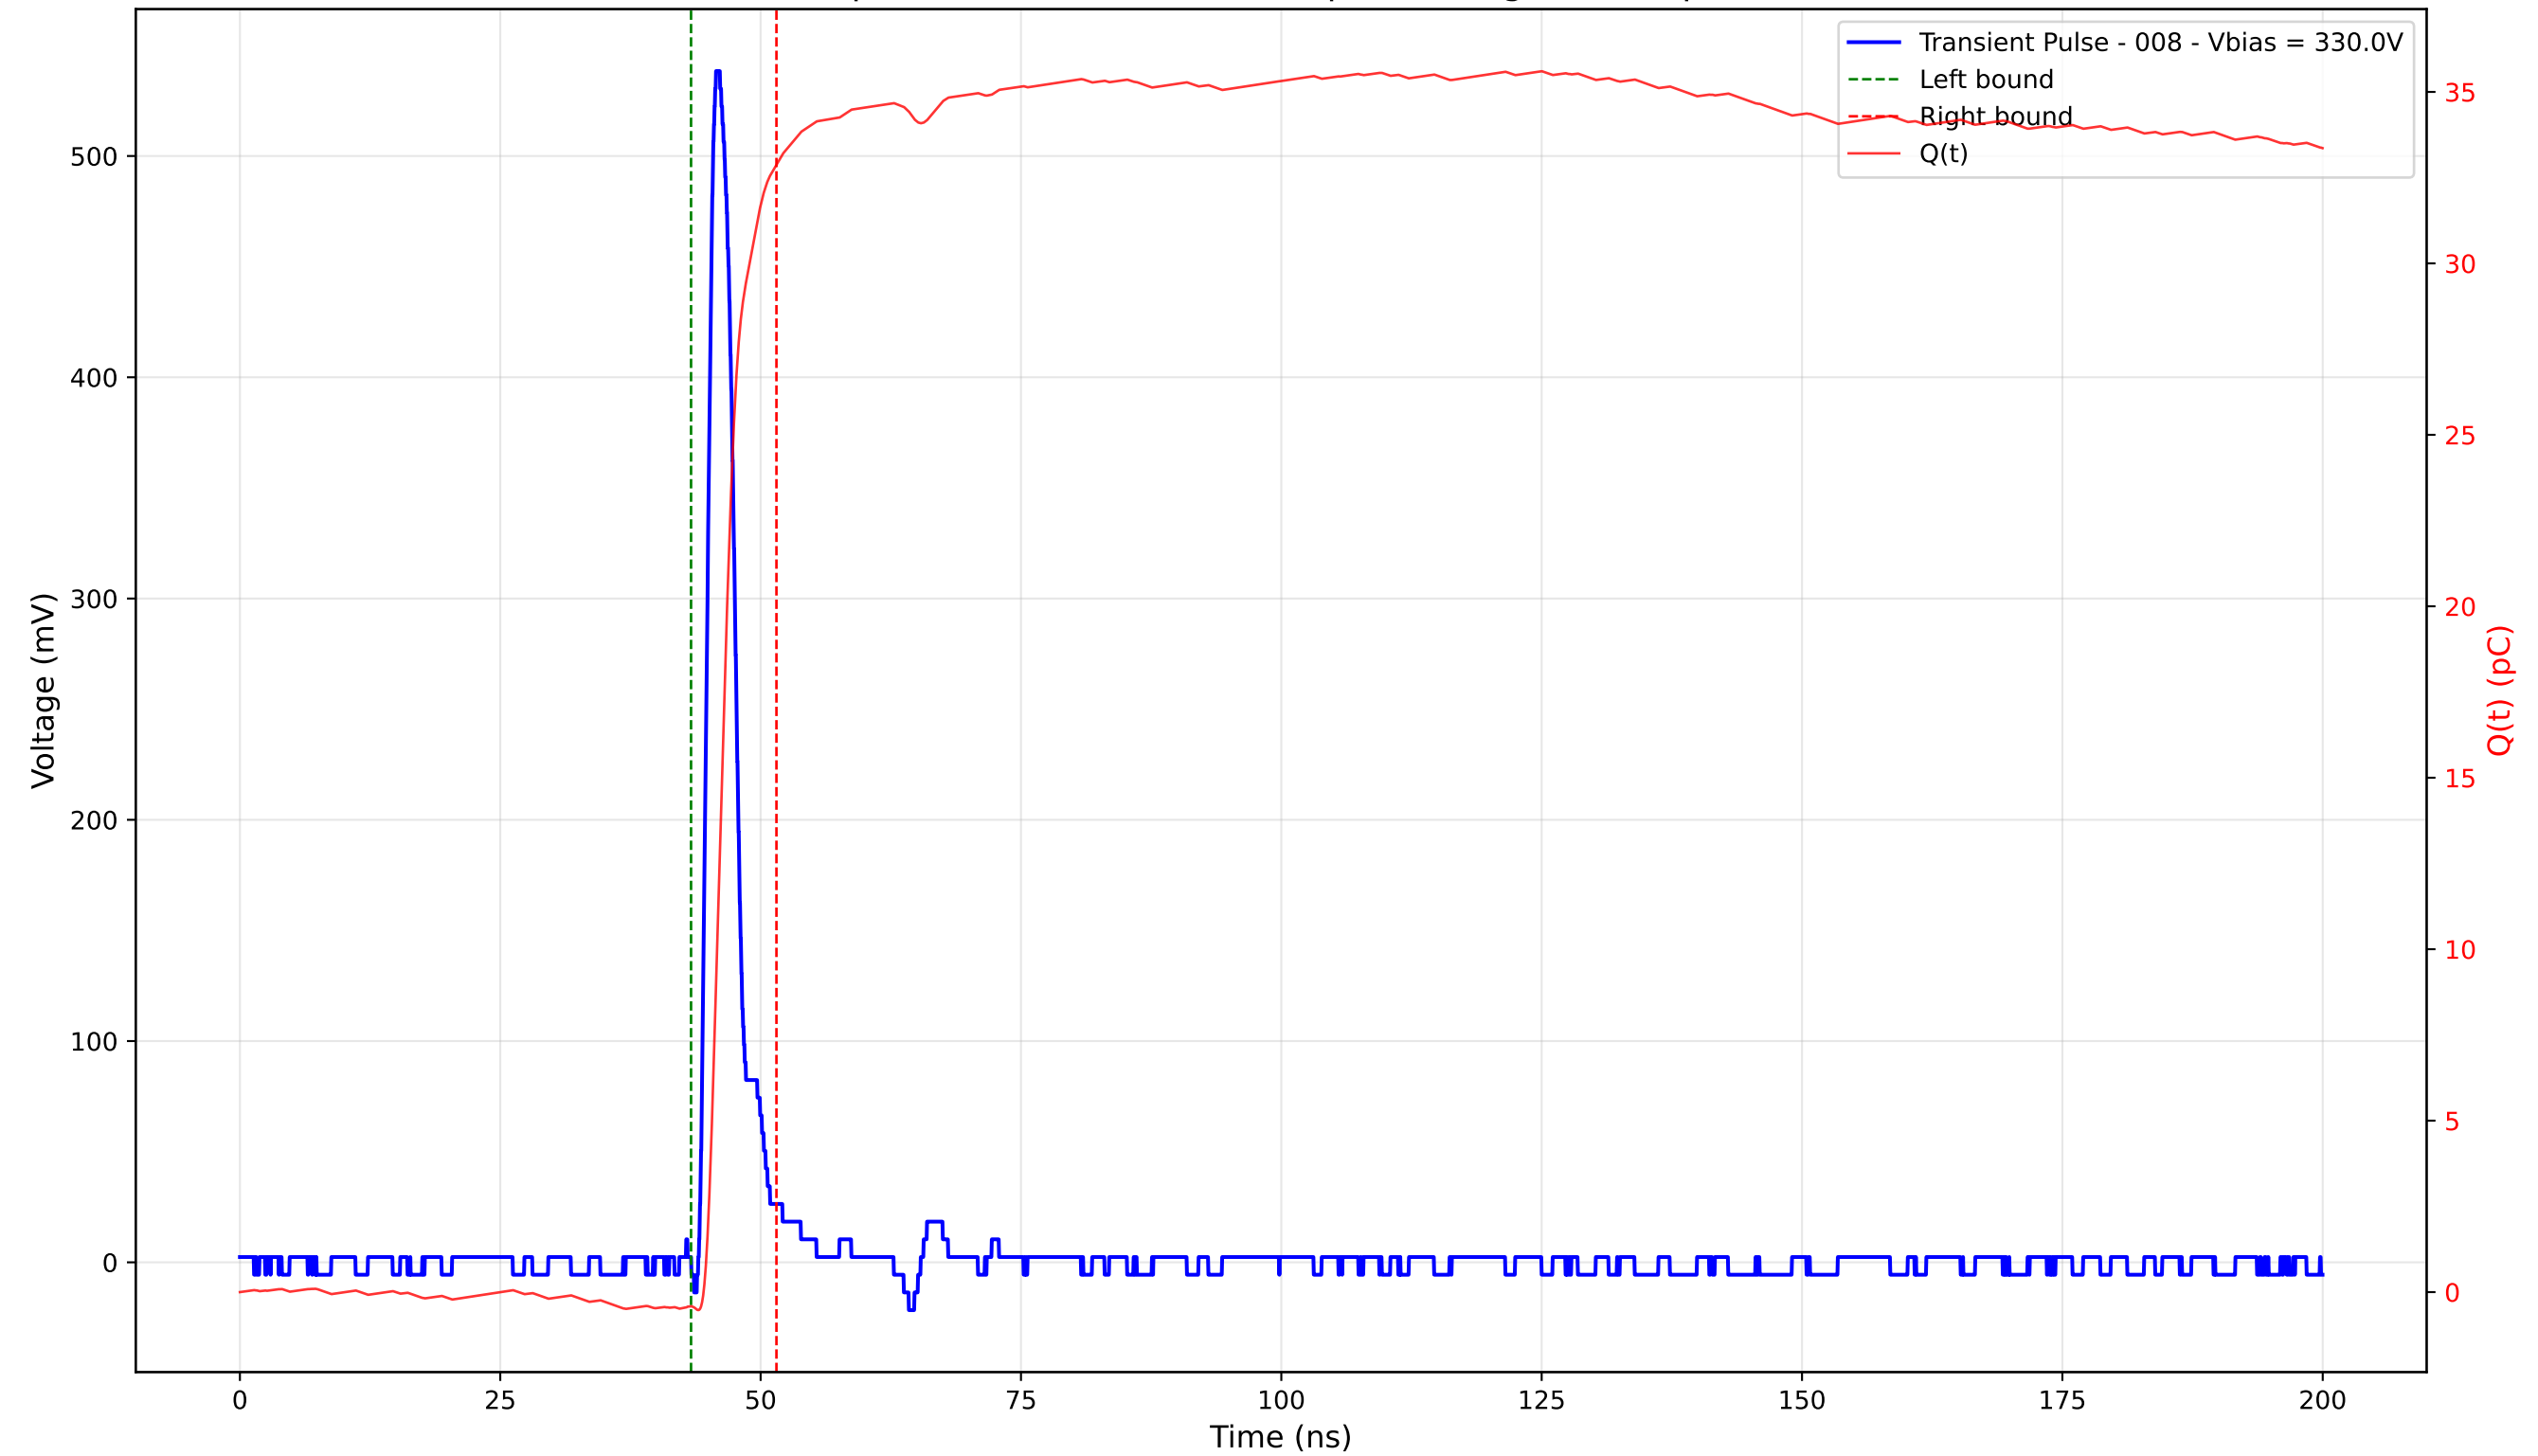


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 33.61 pC - Rise Time: 1.10 ns

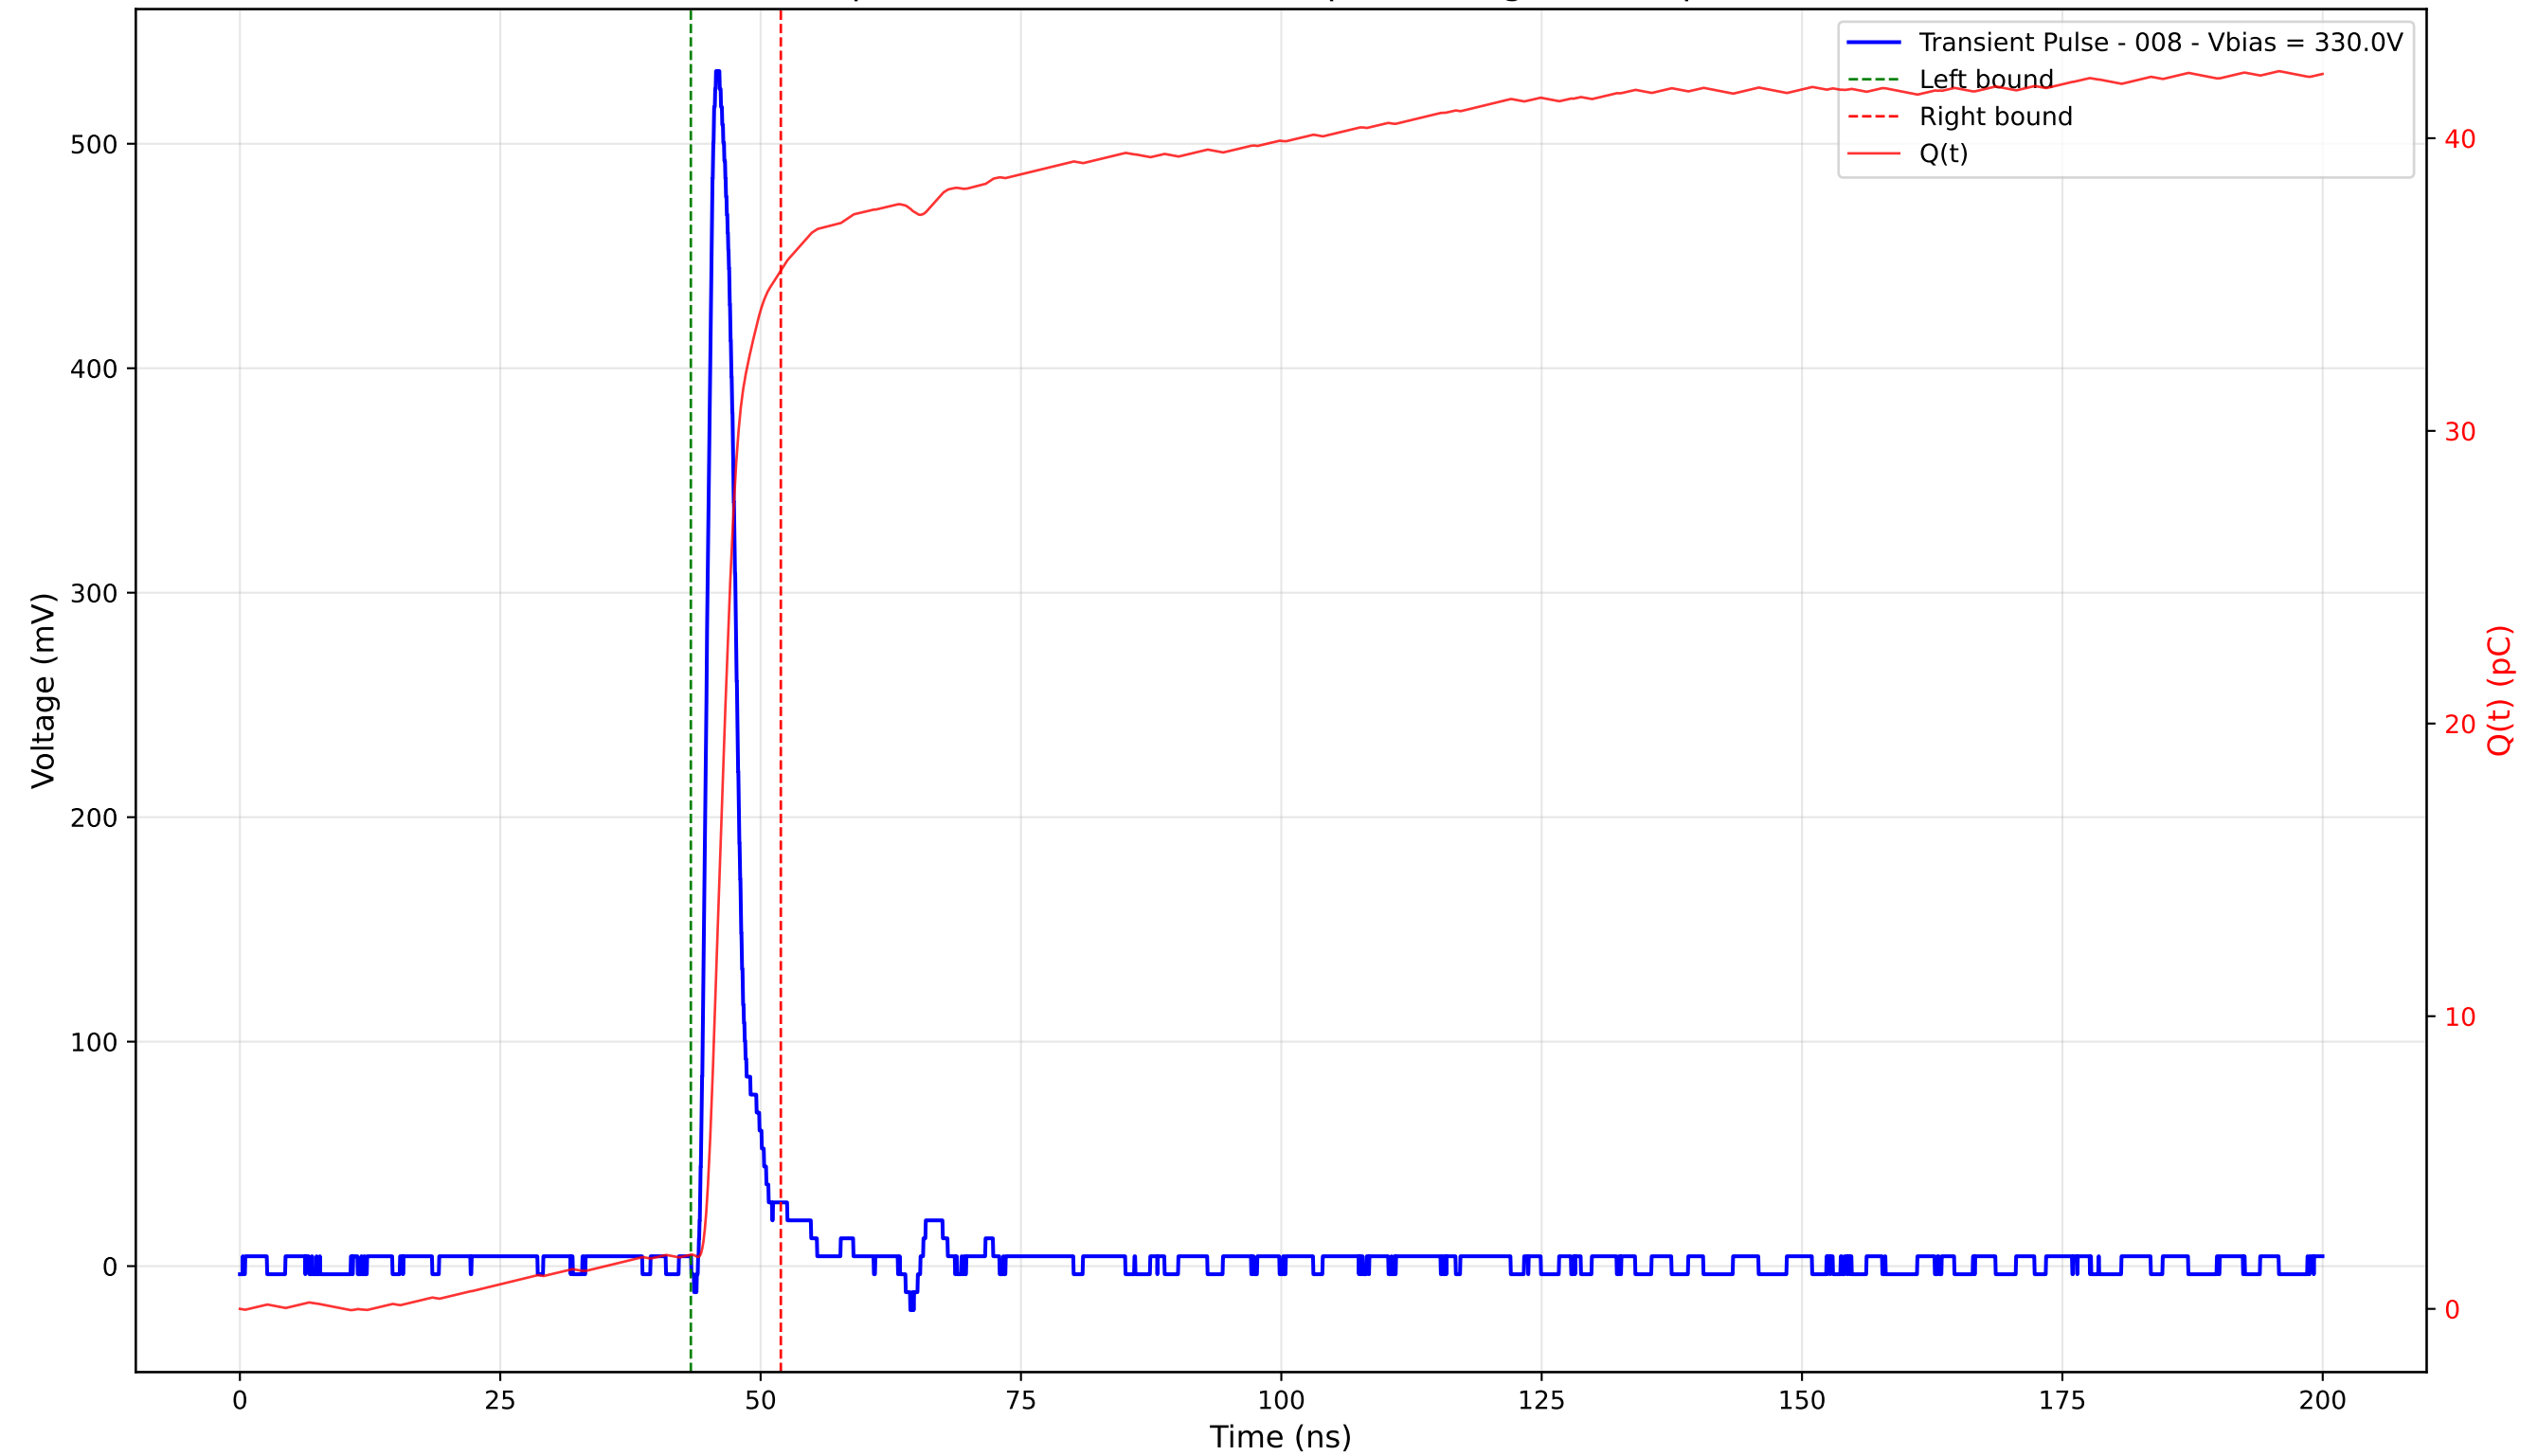


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 32.96 pC - Rise Time: 1.09 ns

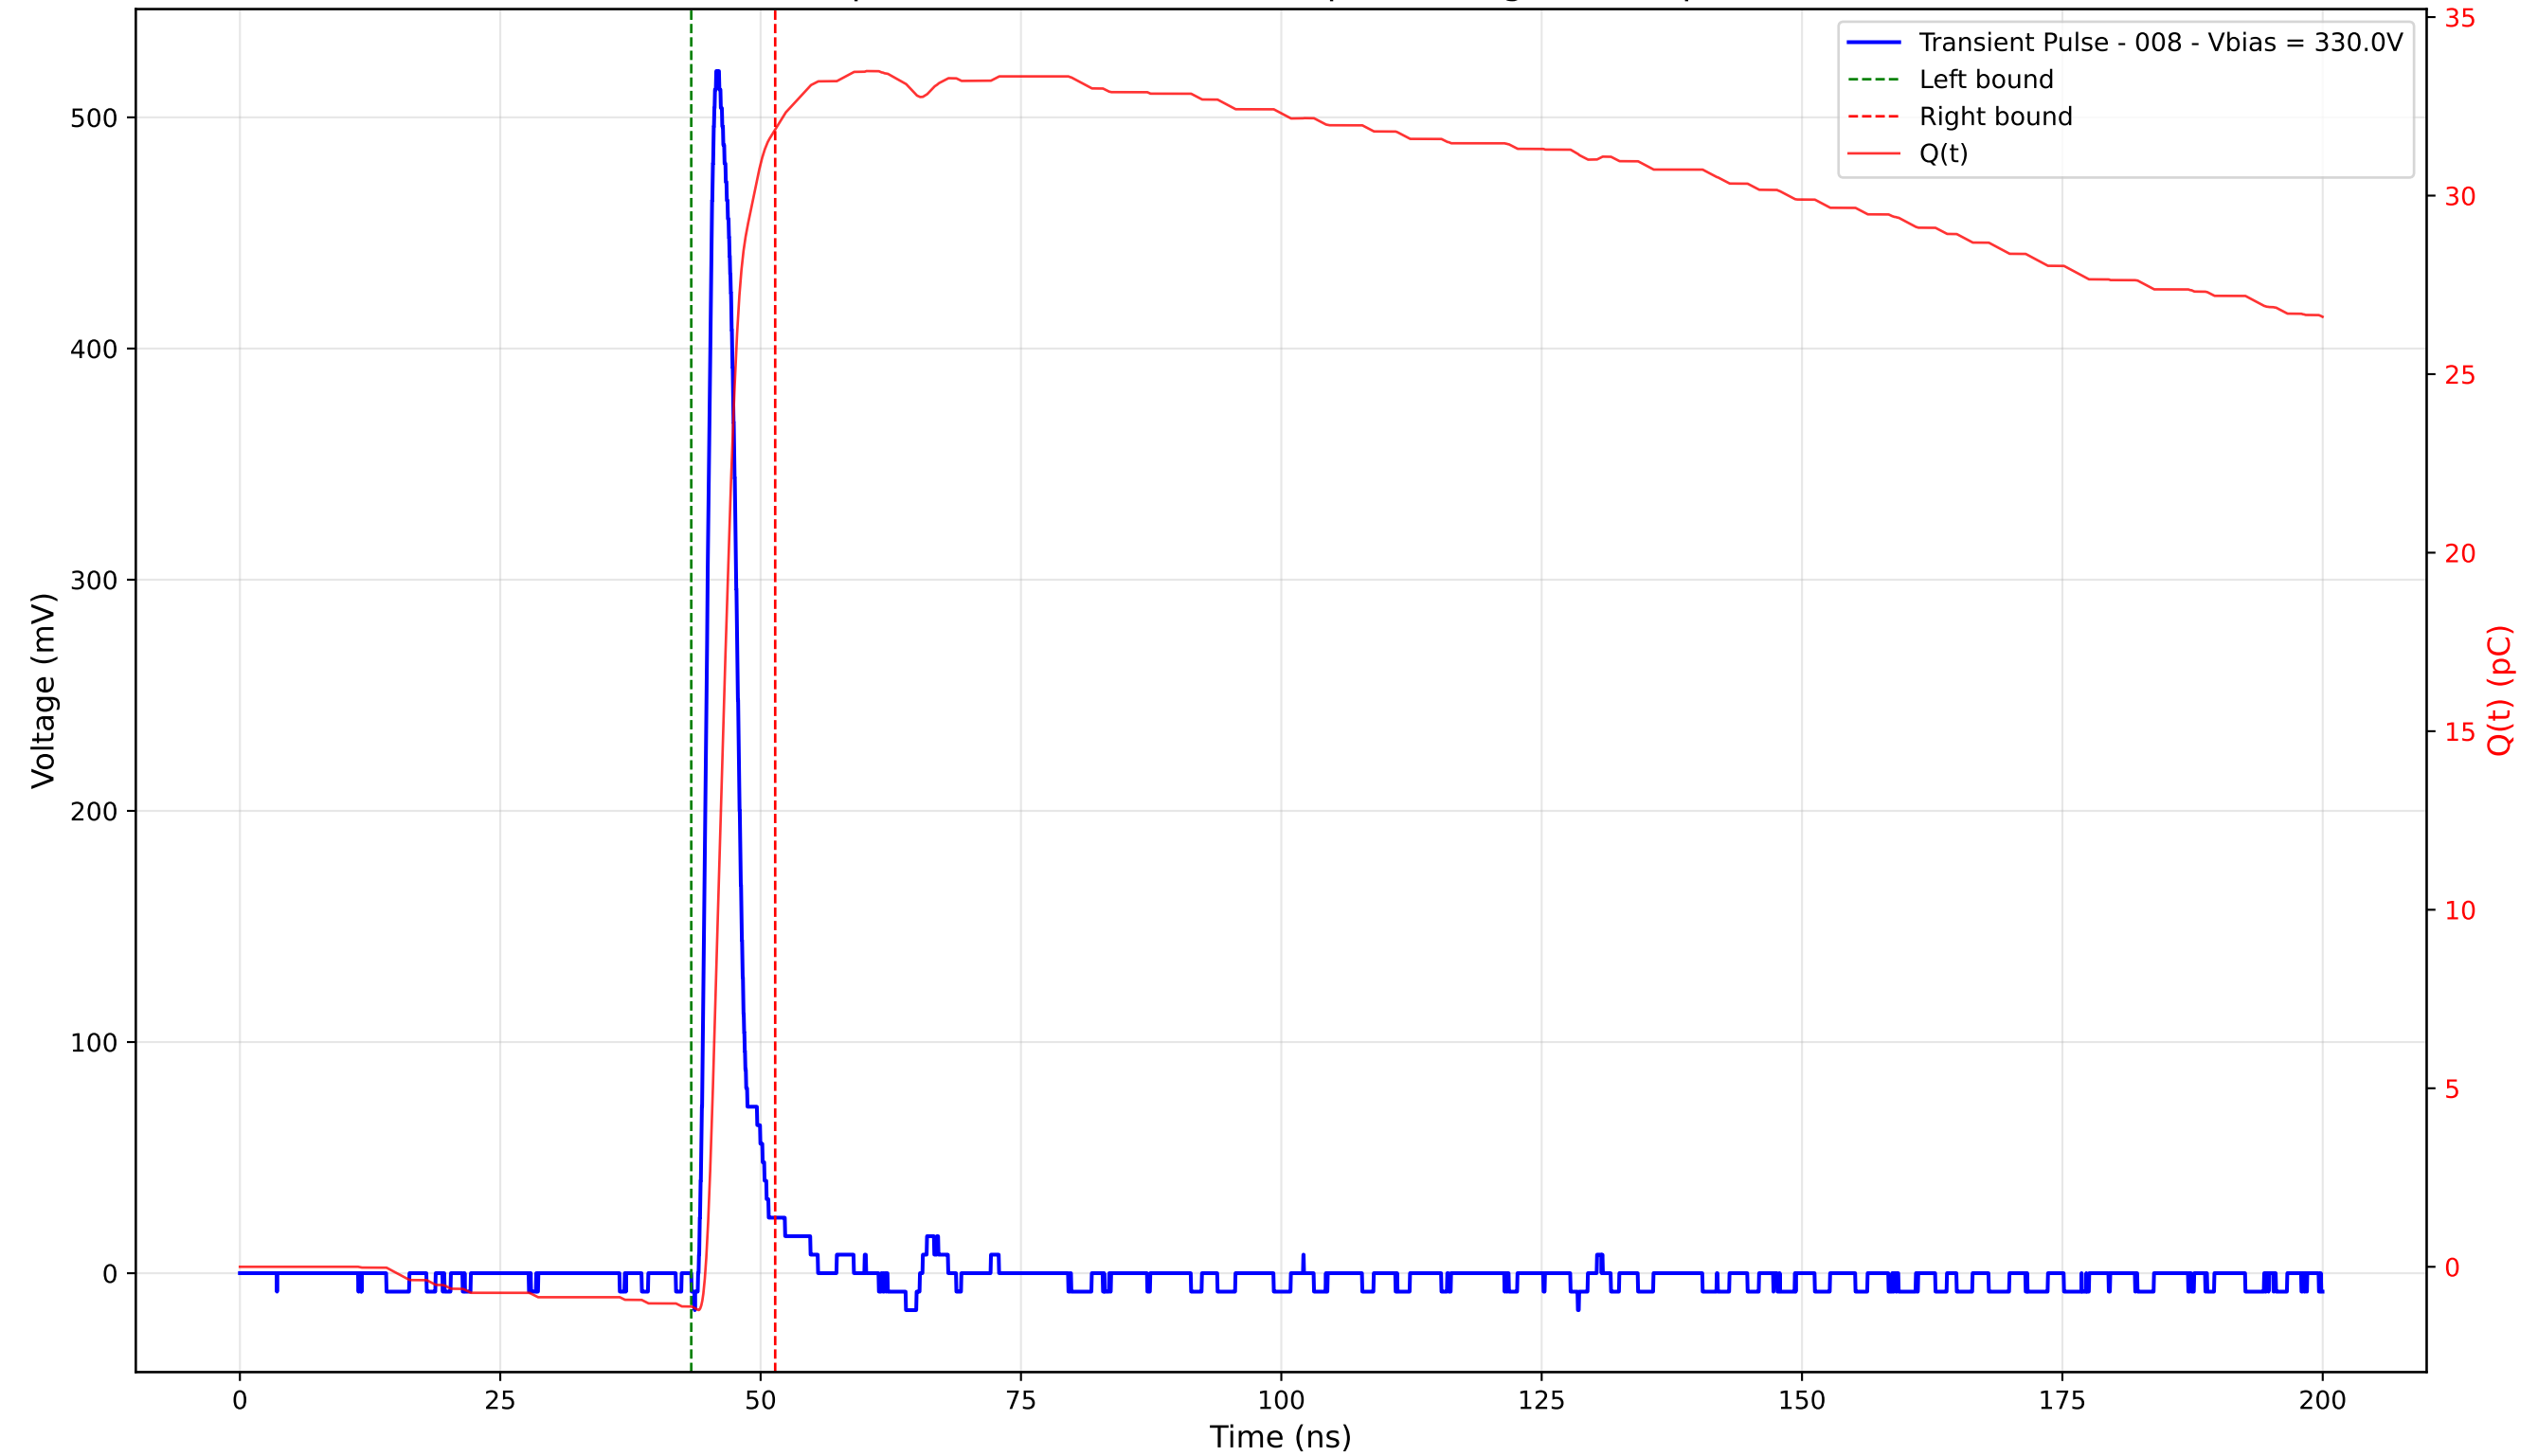


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 32.97 pC - Rise Time: 1.09 ns

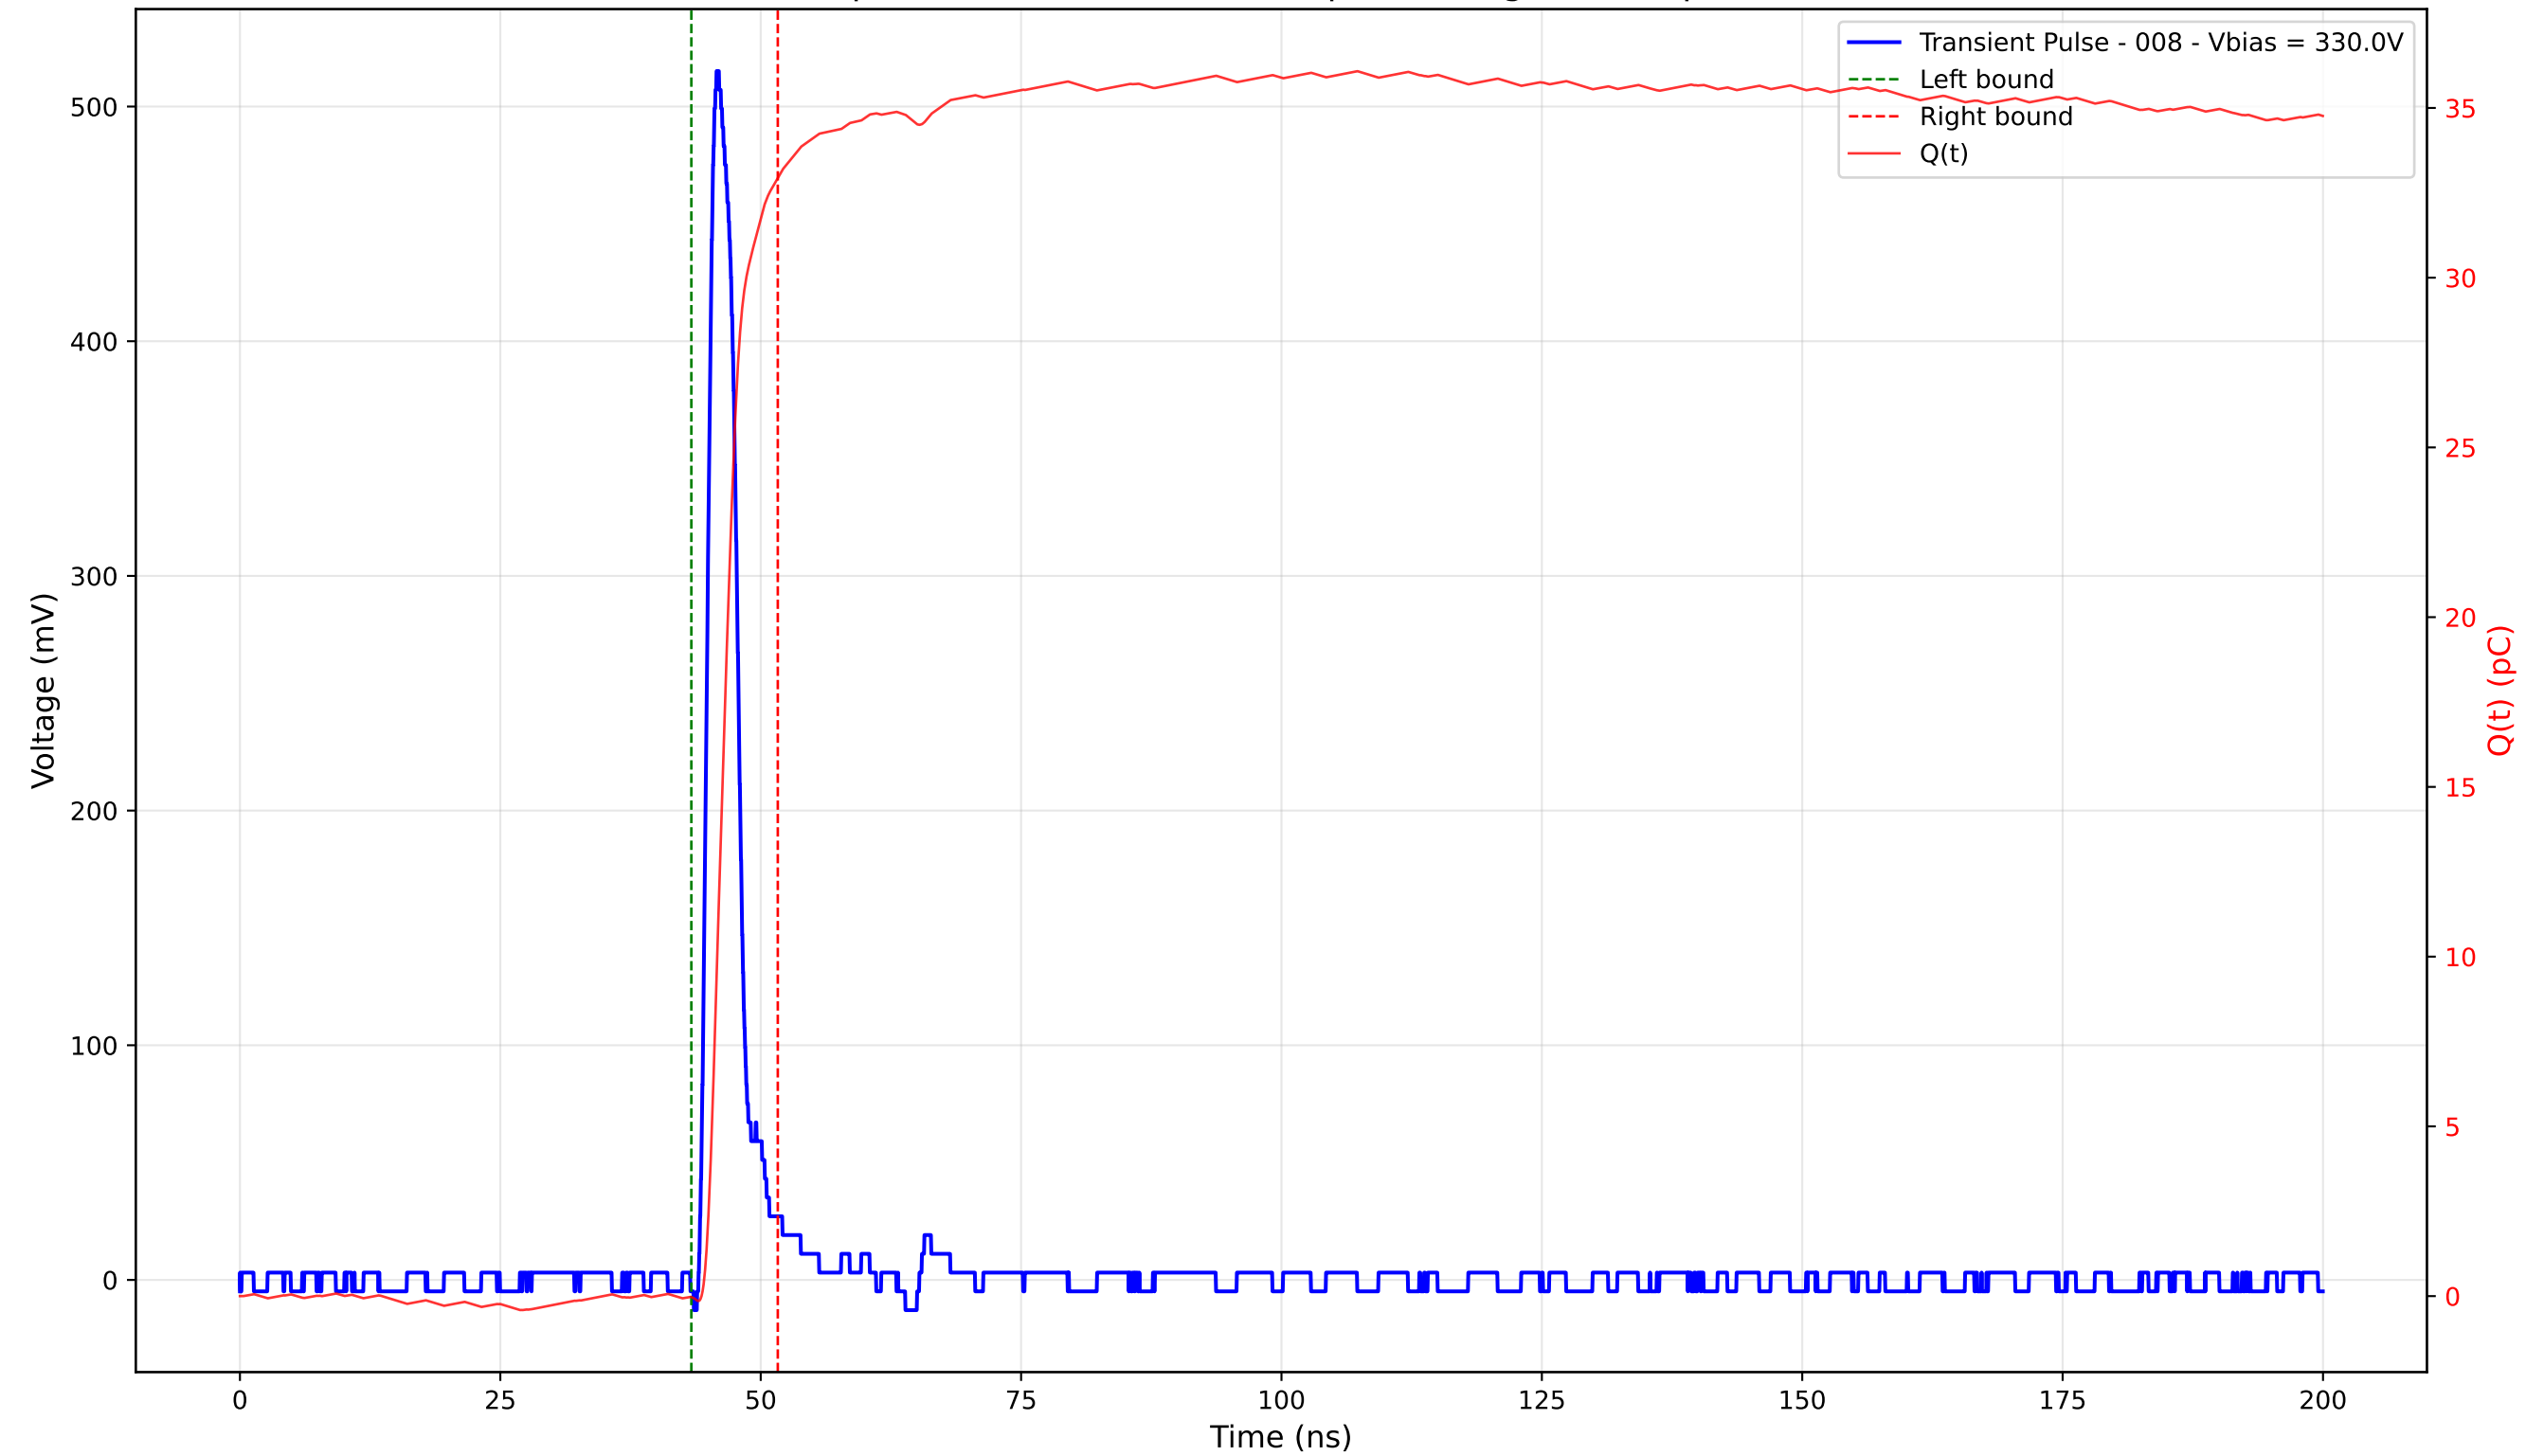


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 33.51 pC - Rise Time: 1.08 ns

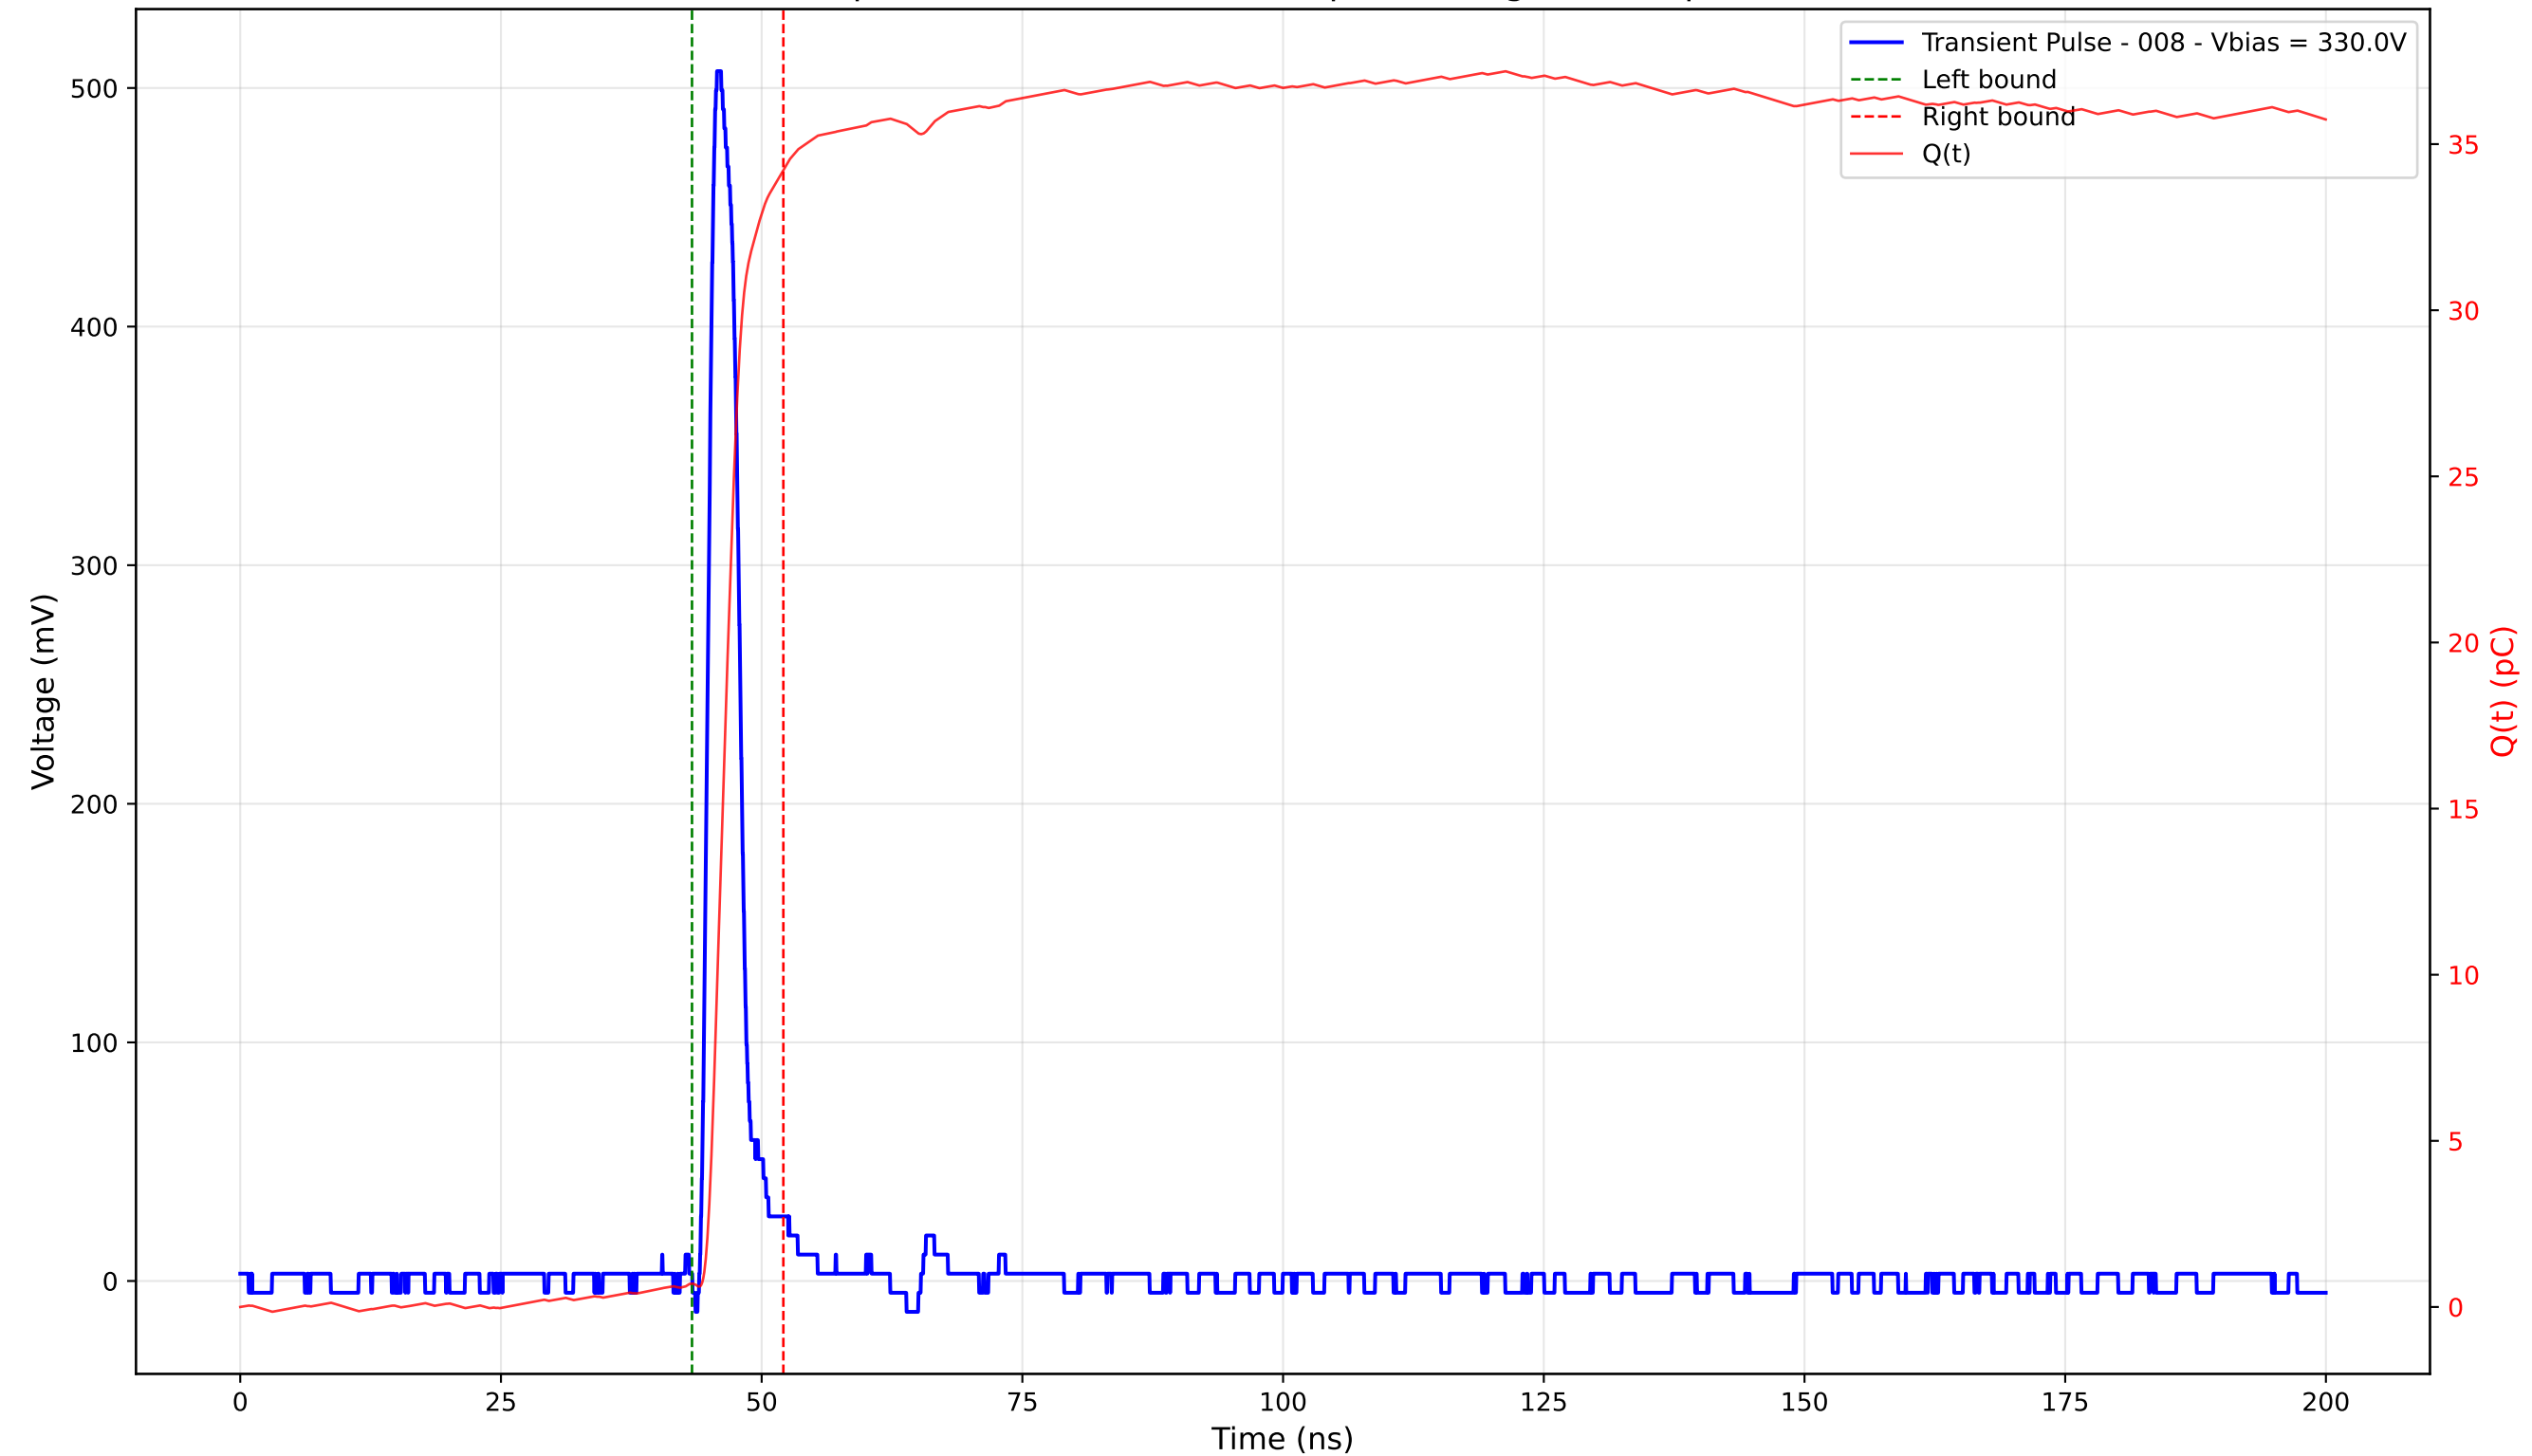


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 33.18 pC - Rise Time: 1.10 ns

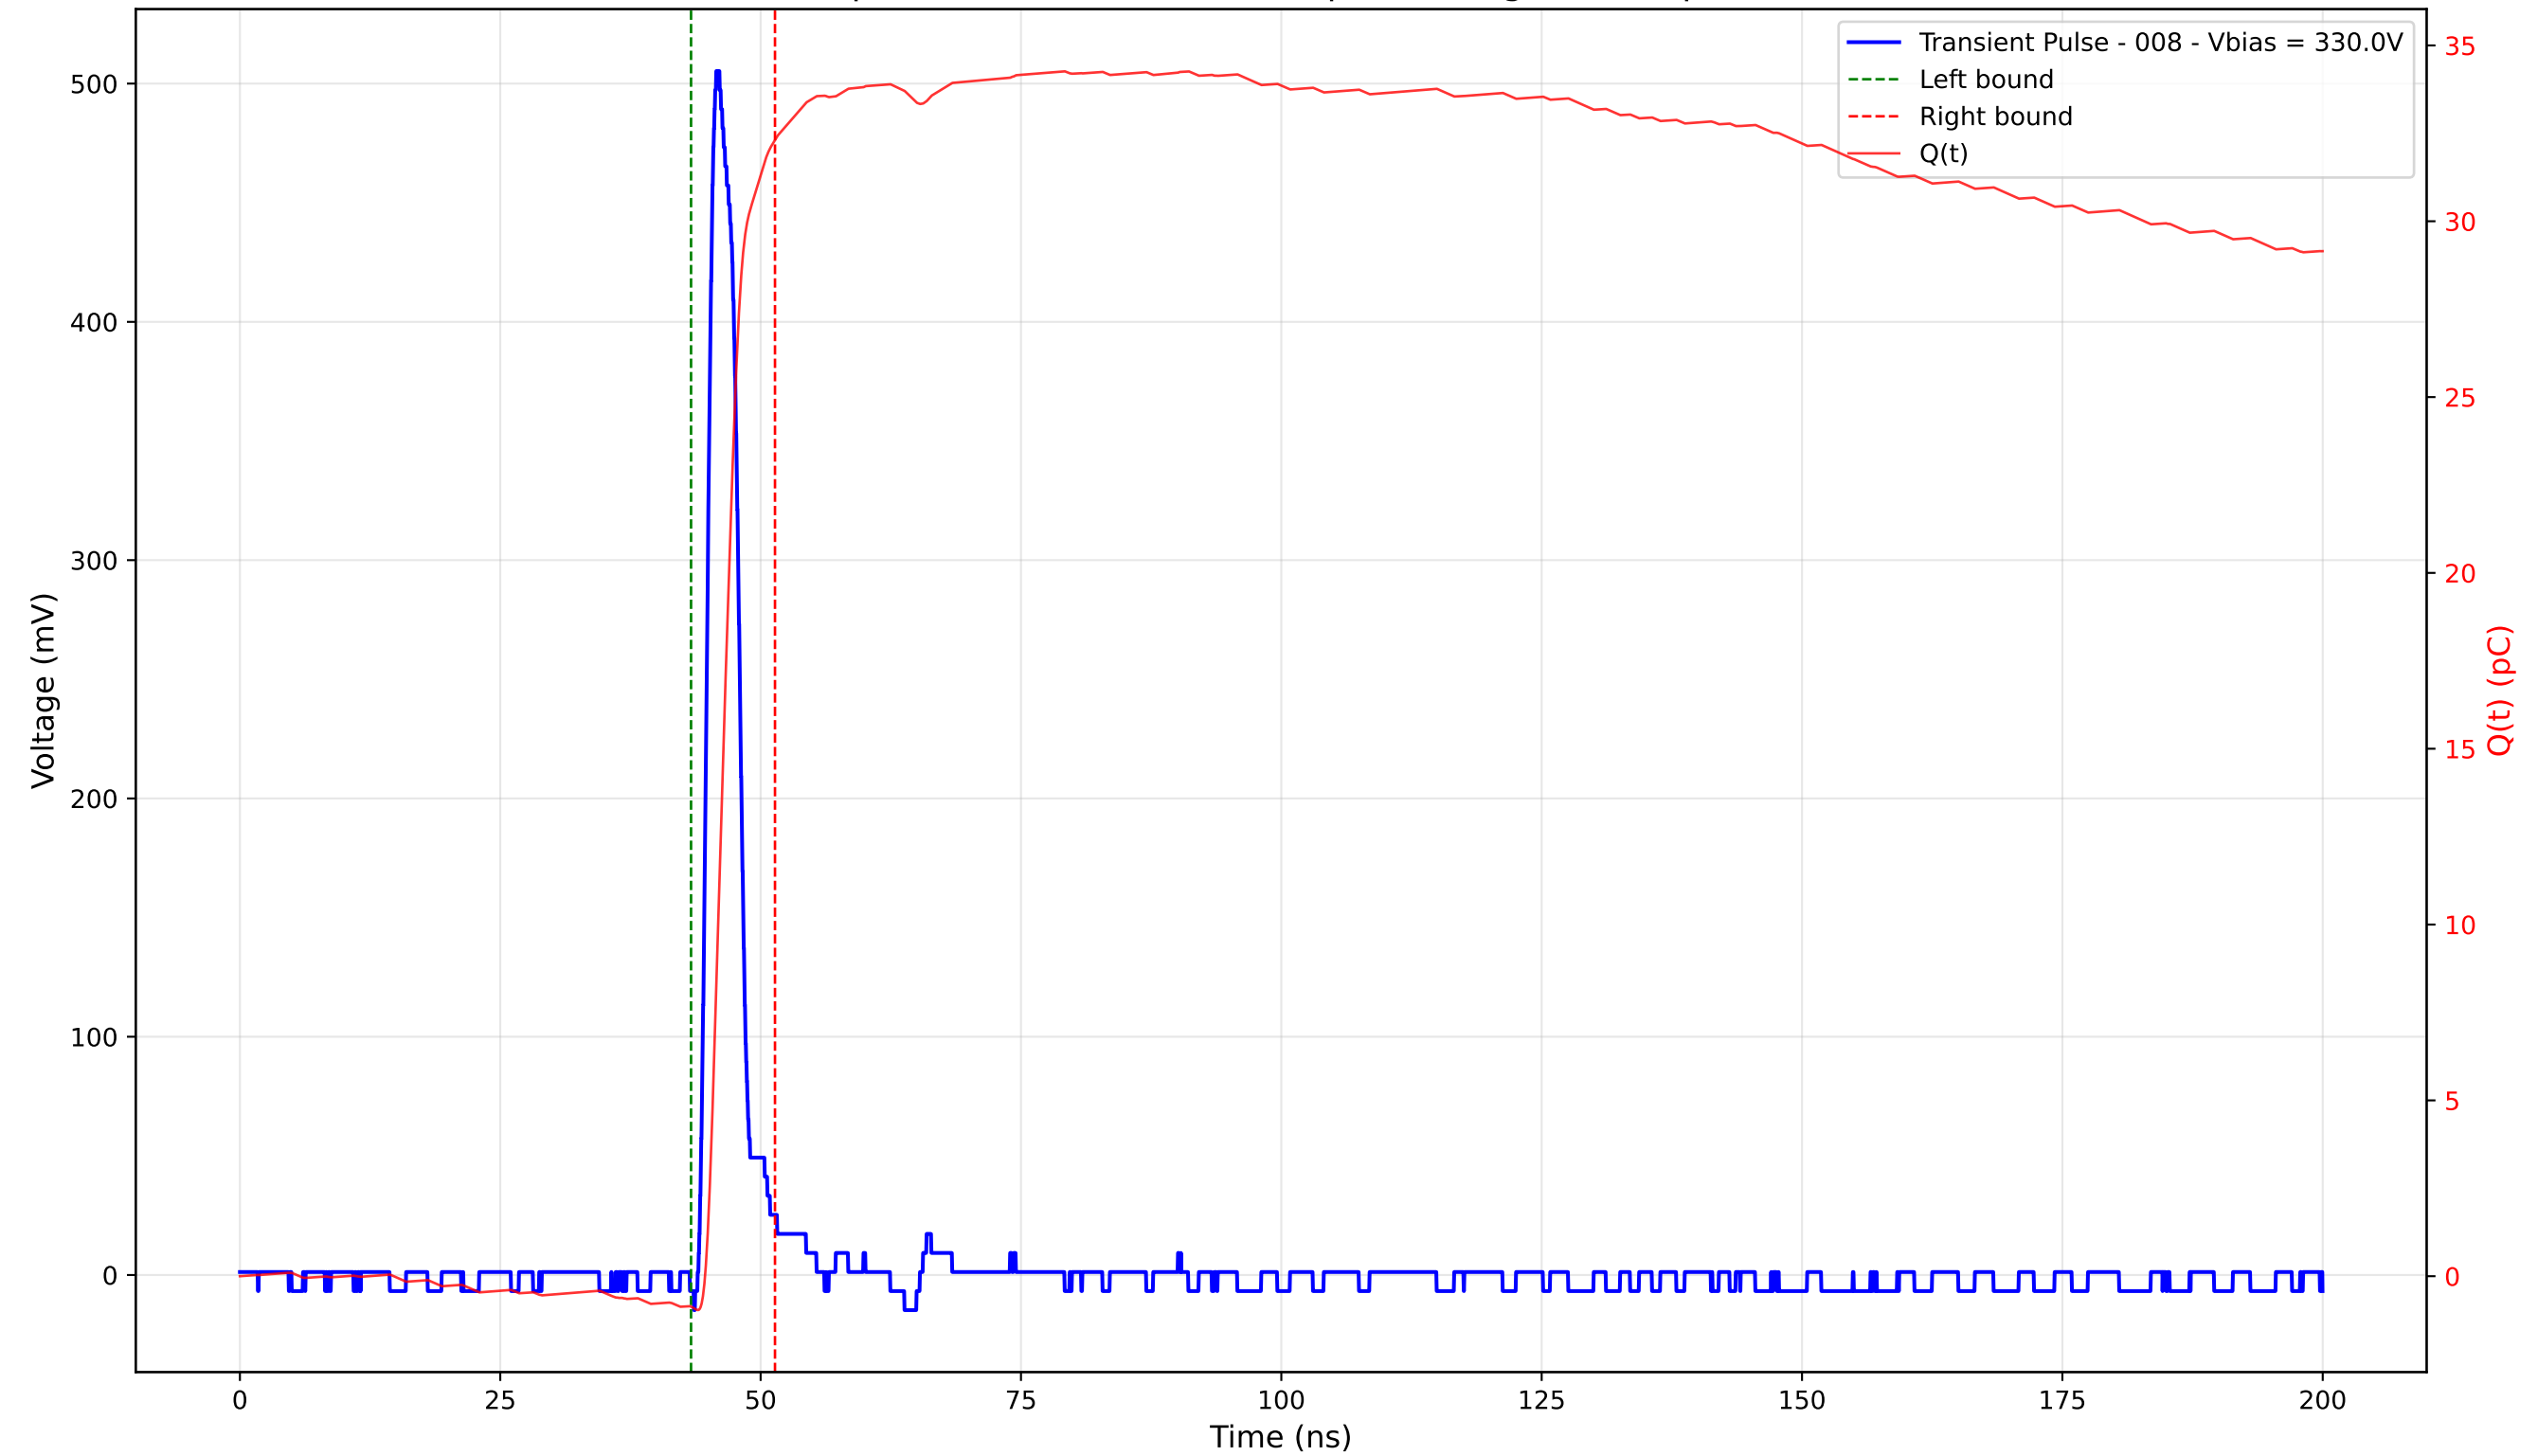


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 33.45 pC - Rise Time: 1.11 ns

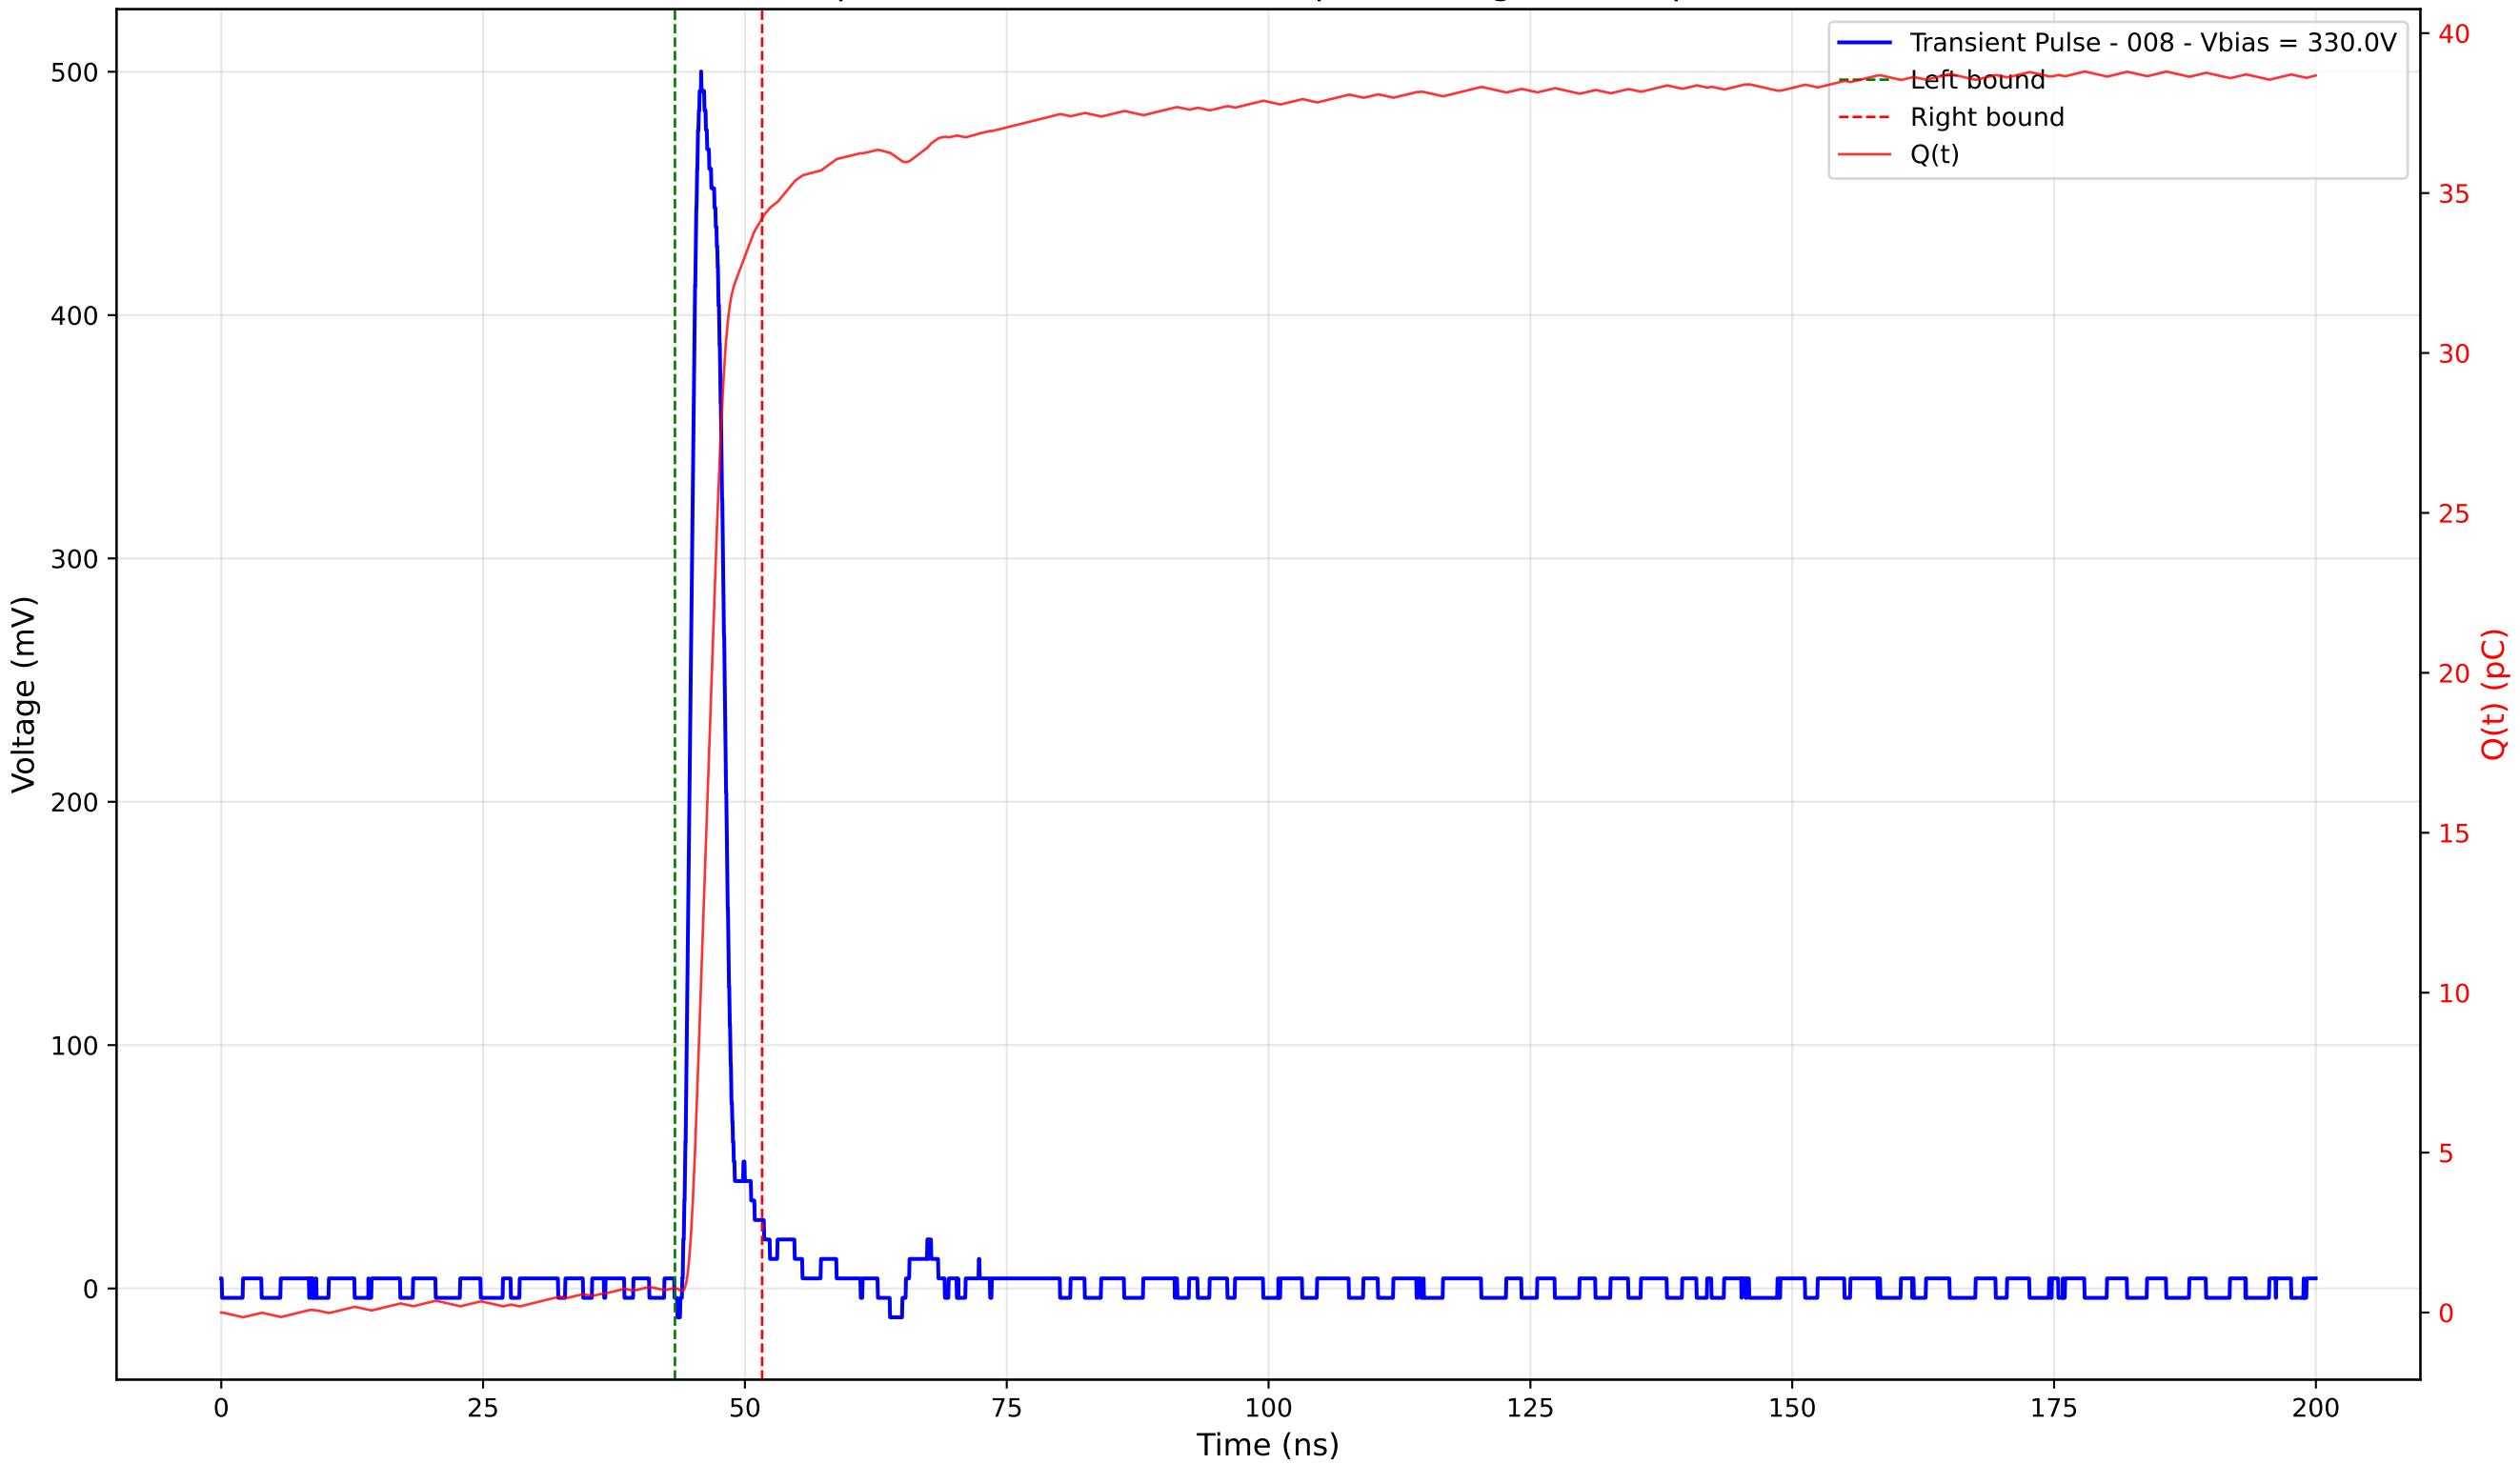


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 33.19 pC - Rise Time: 1.08 ns

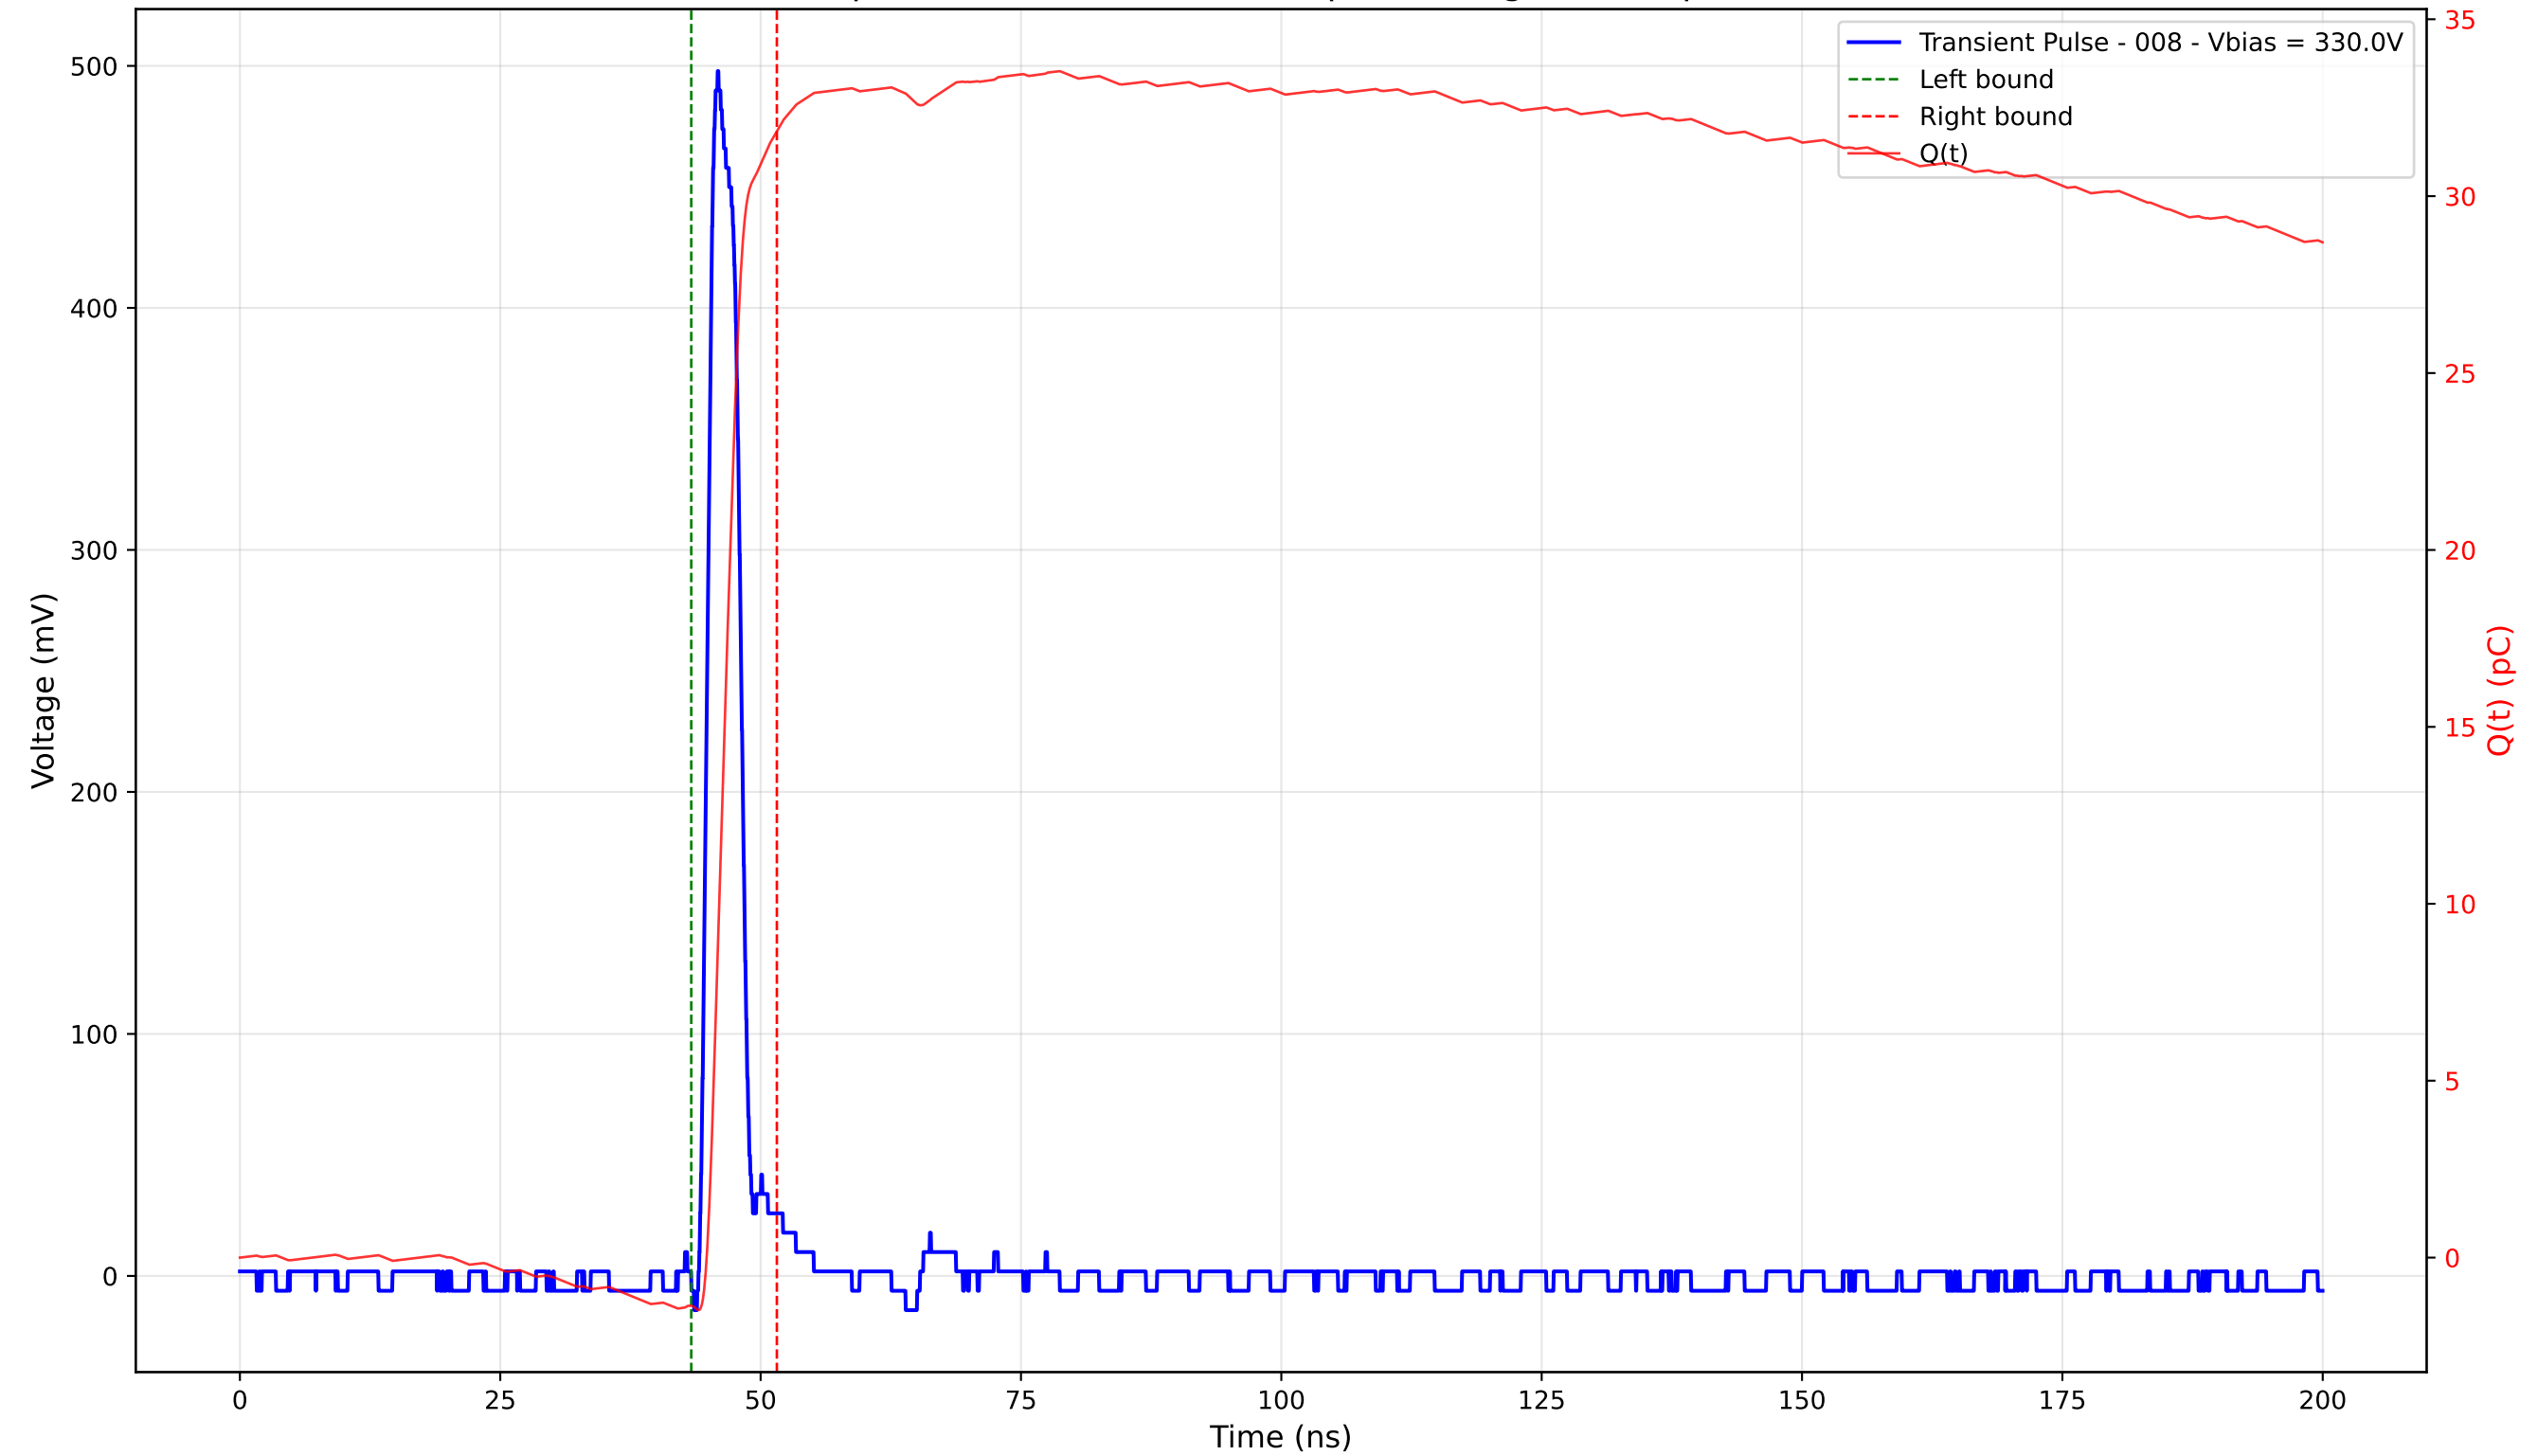


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 34.13 pC - Rise Time: 1.07 ns

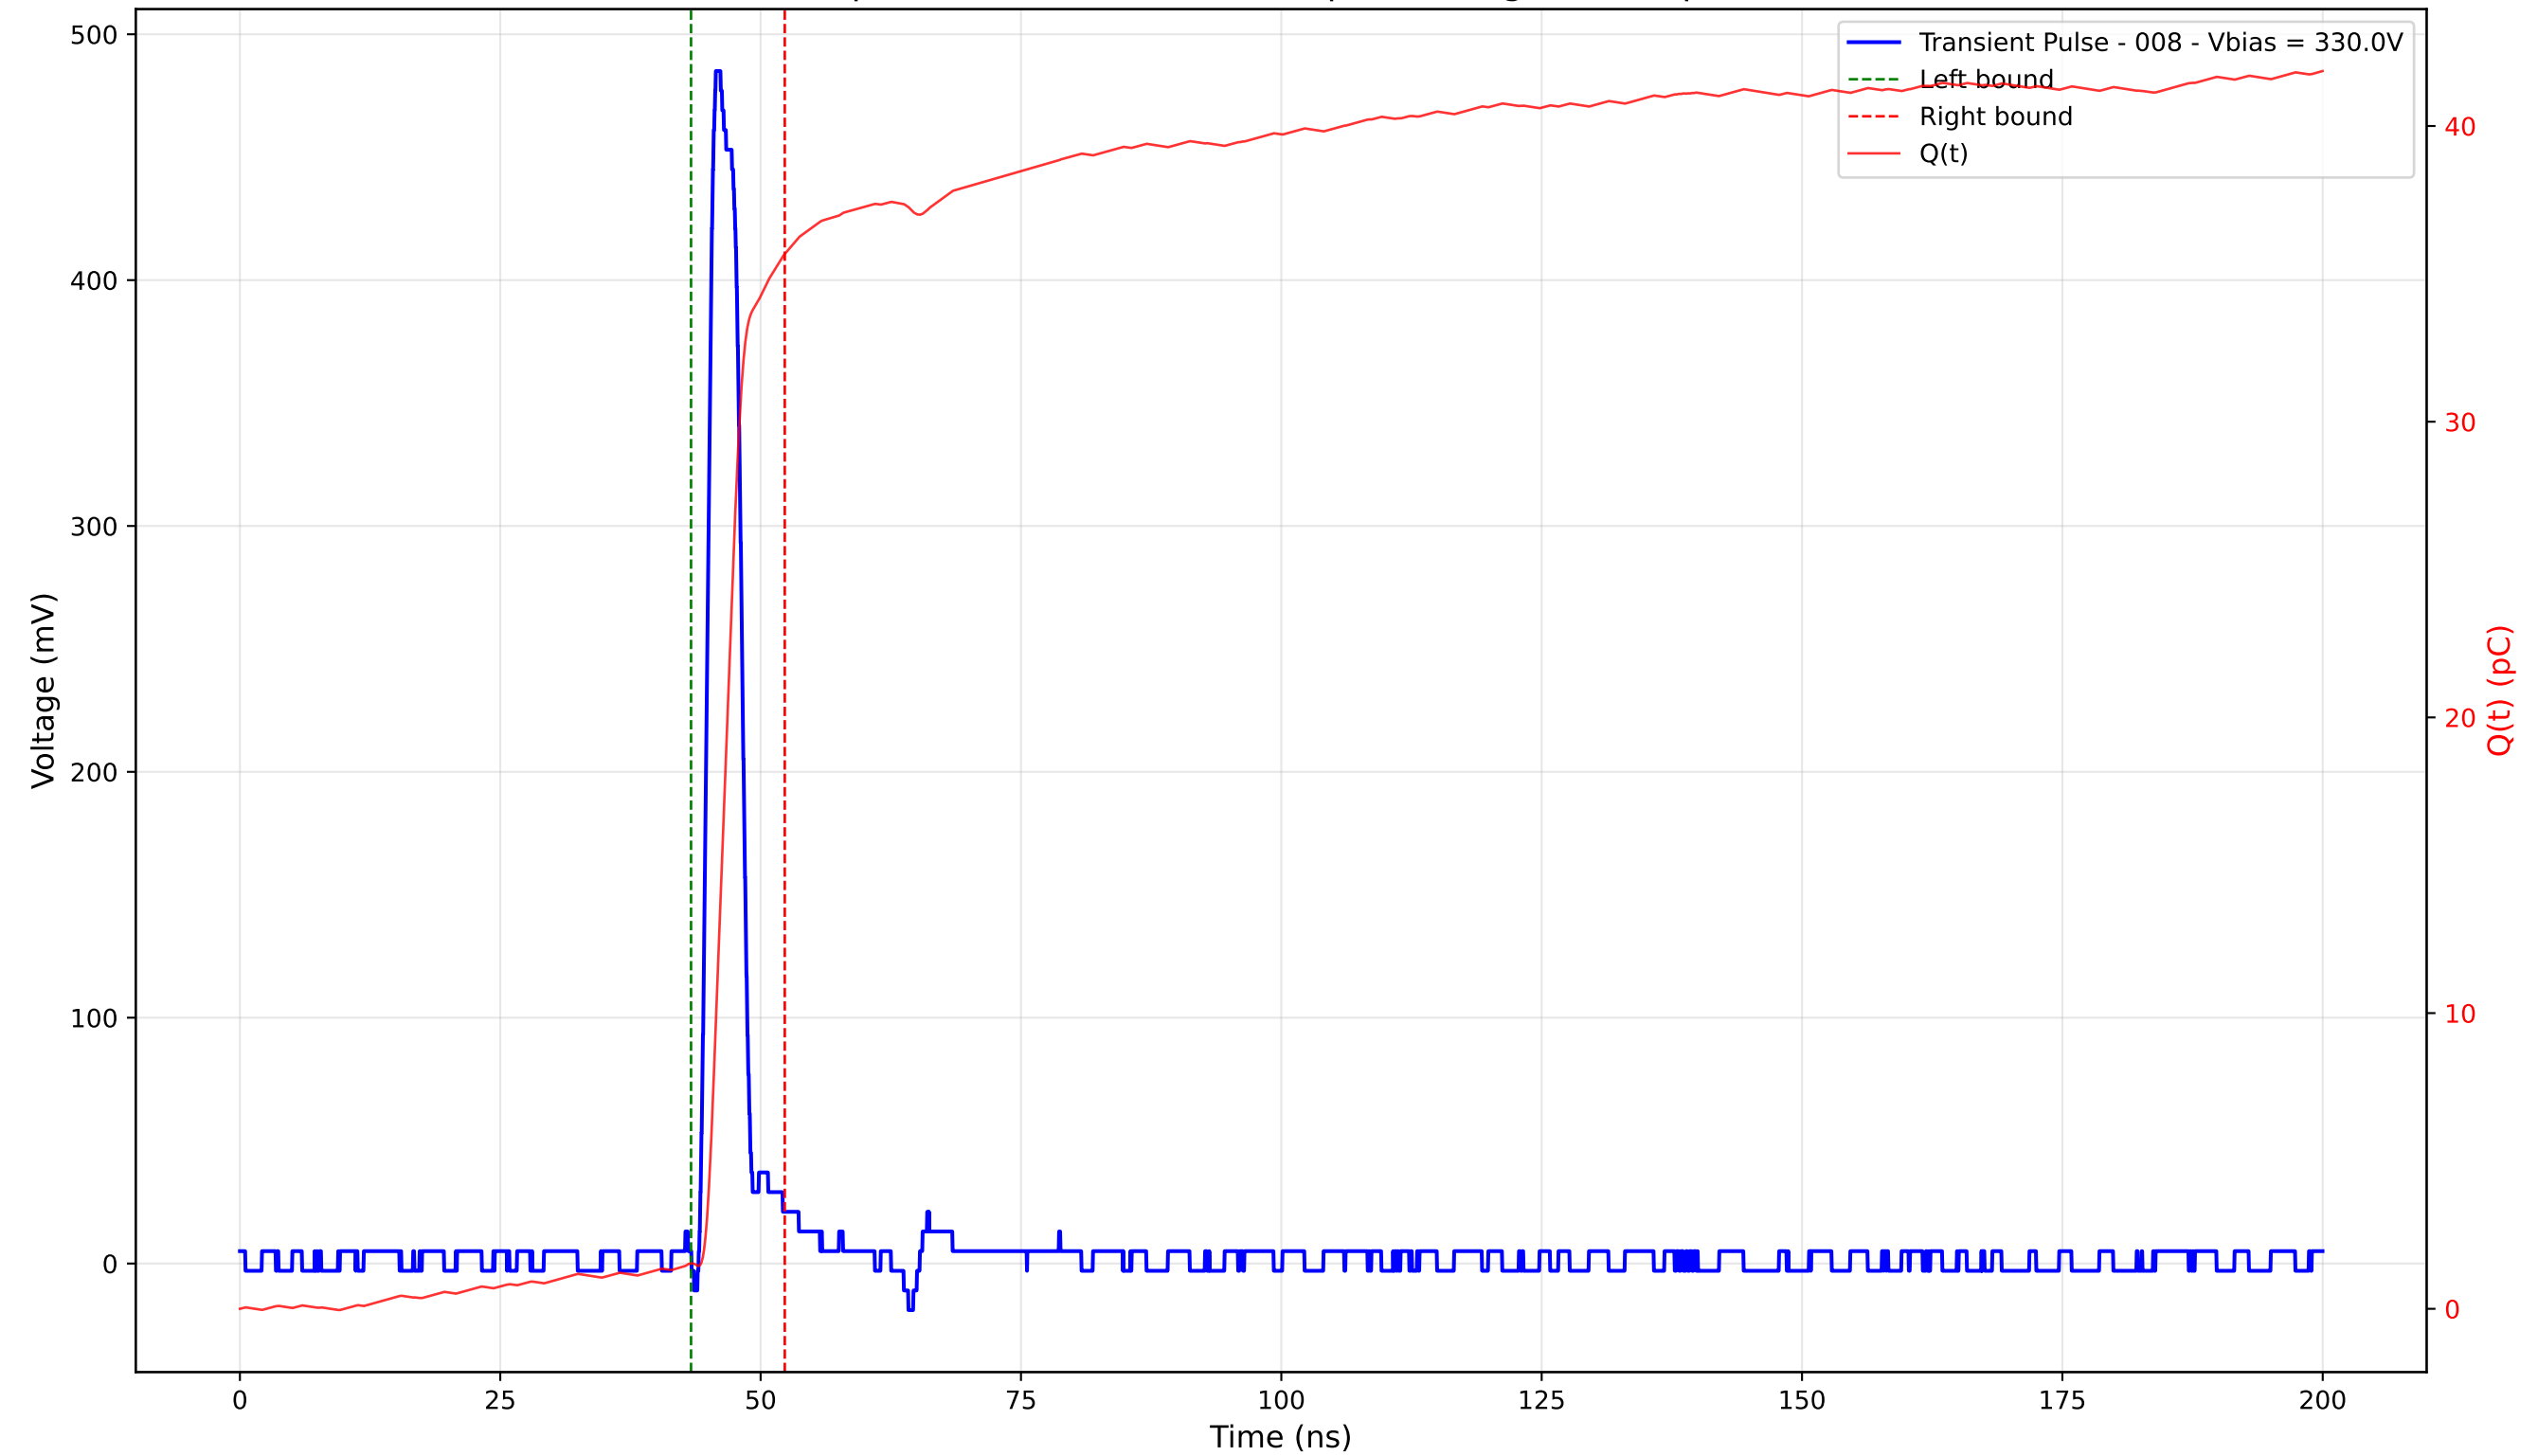


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 33.00 pC - Rise Time: 1.13 ns

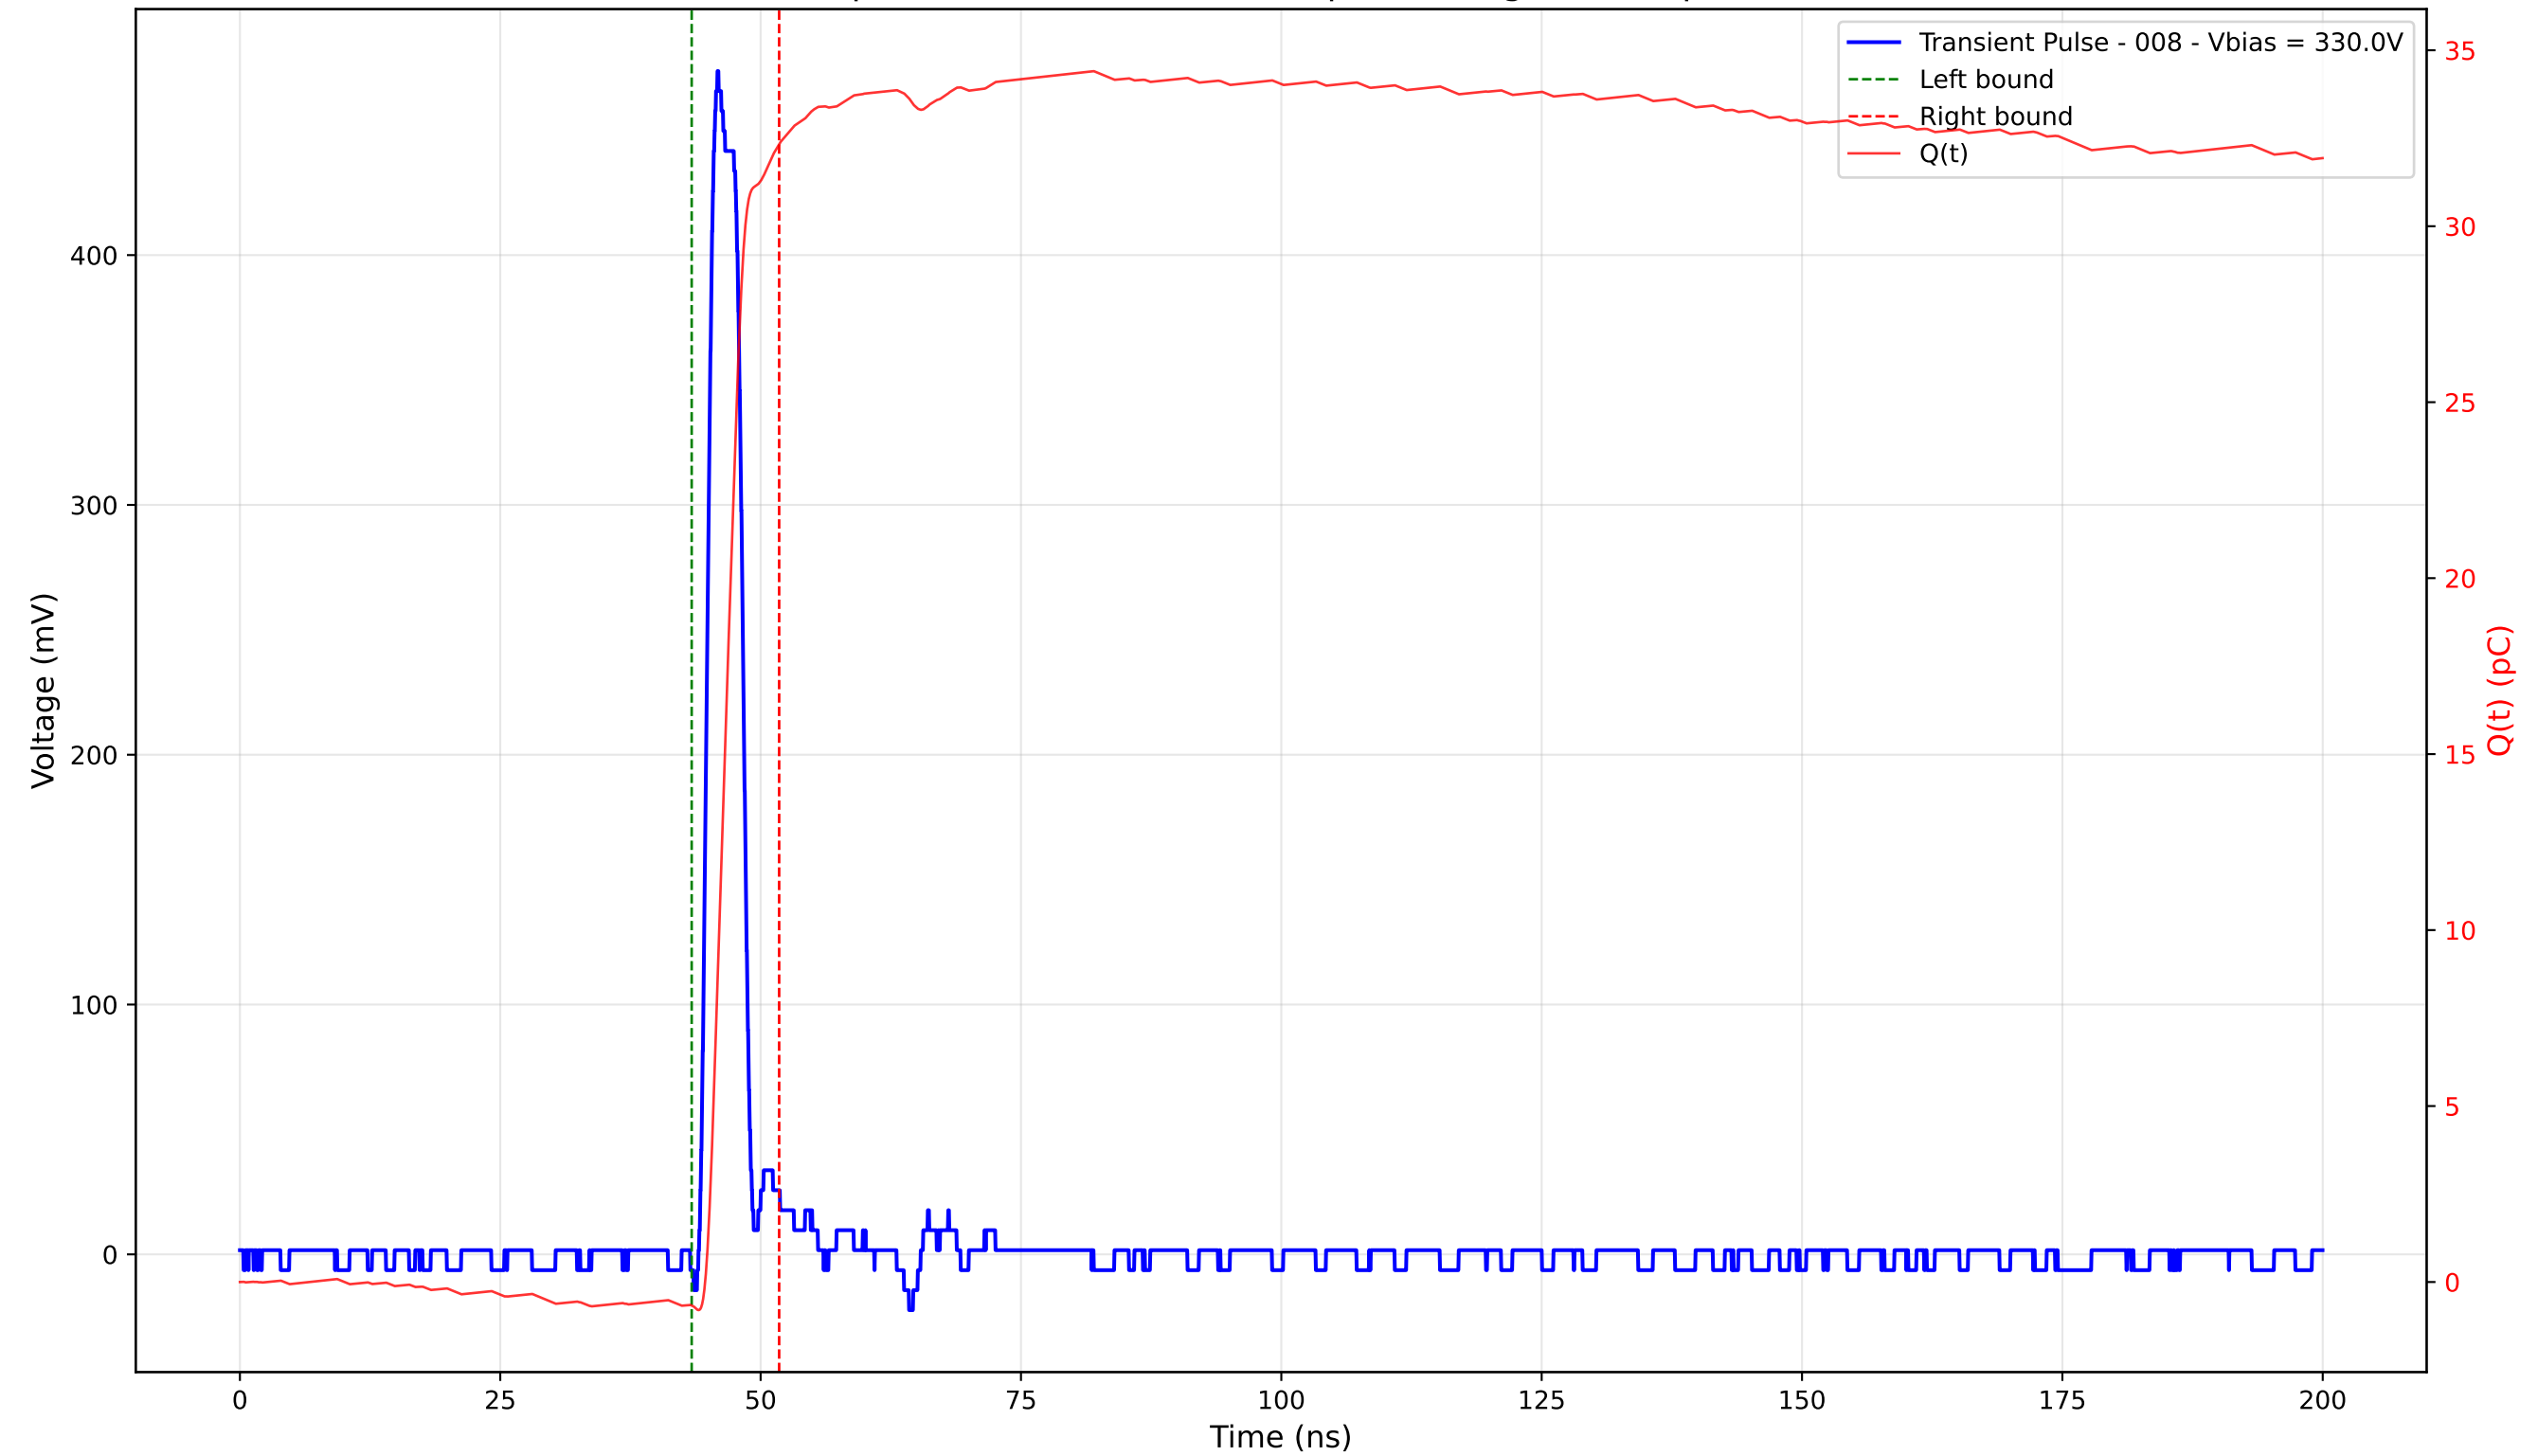


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 33.68 pC - Rise Time: 1.13 ns

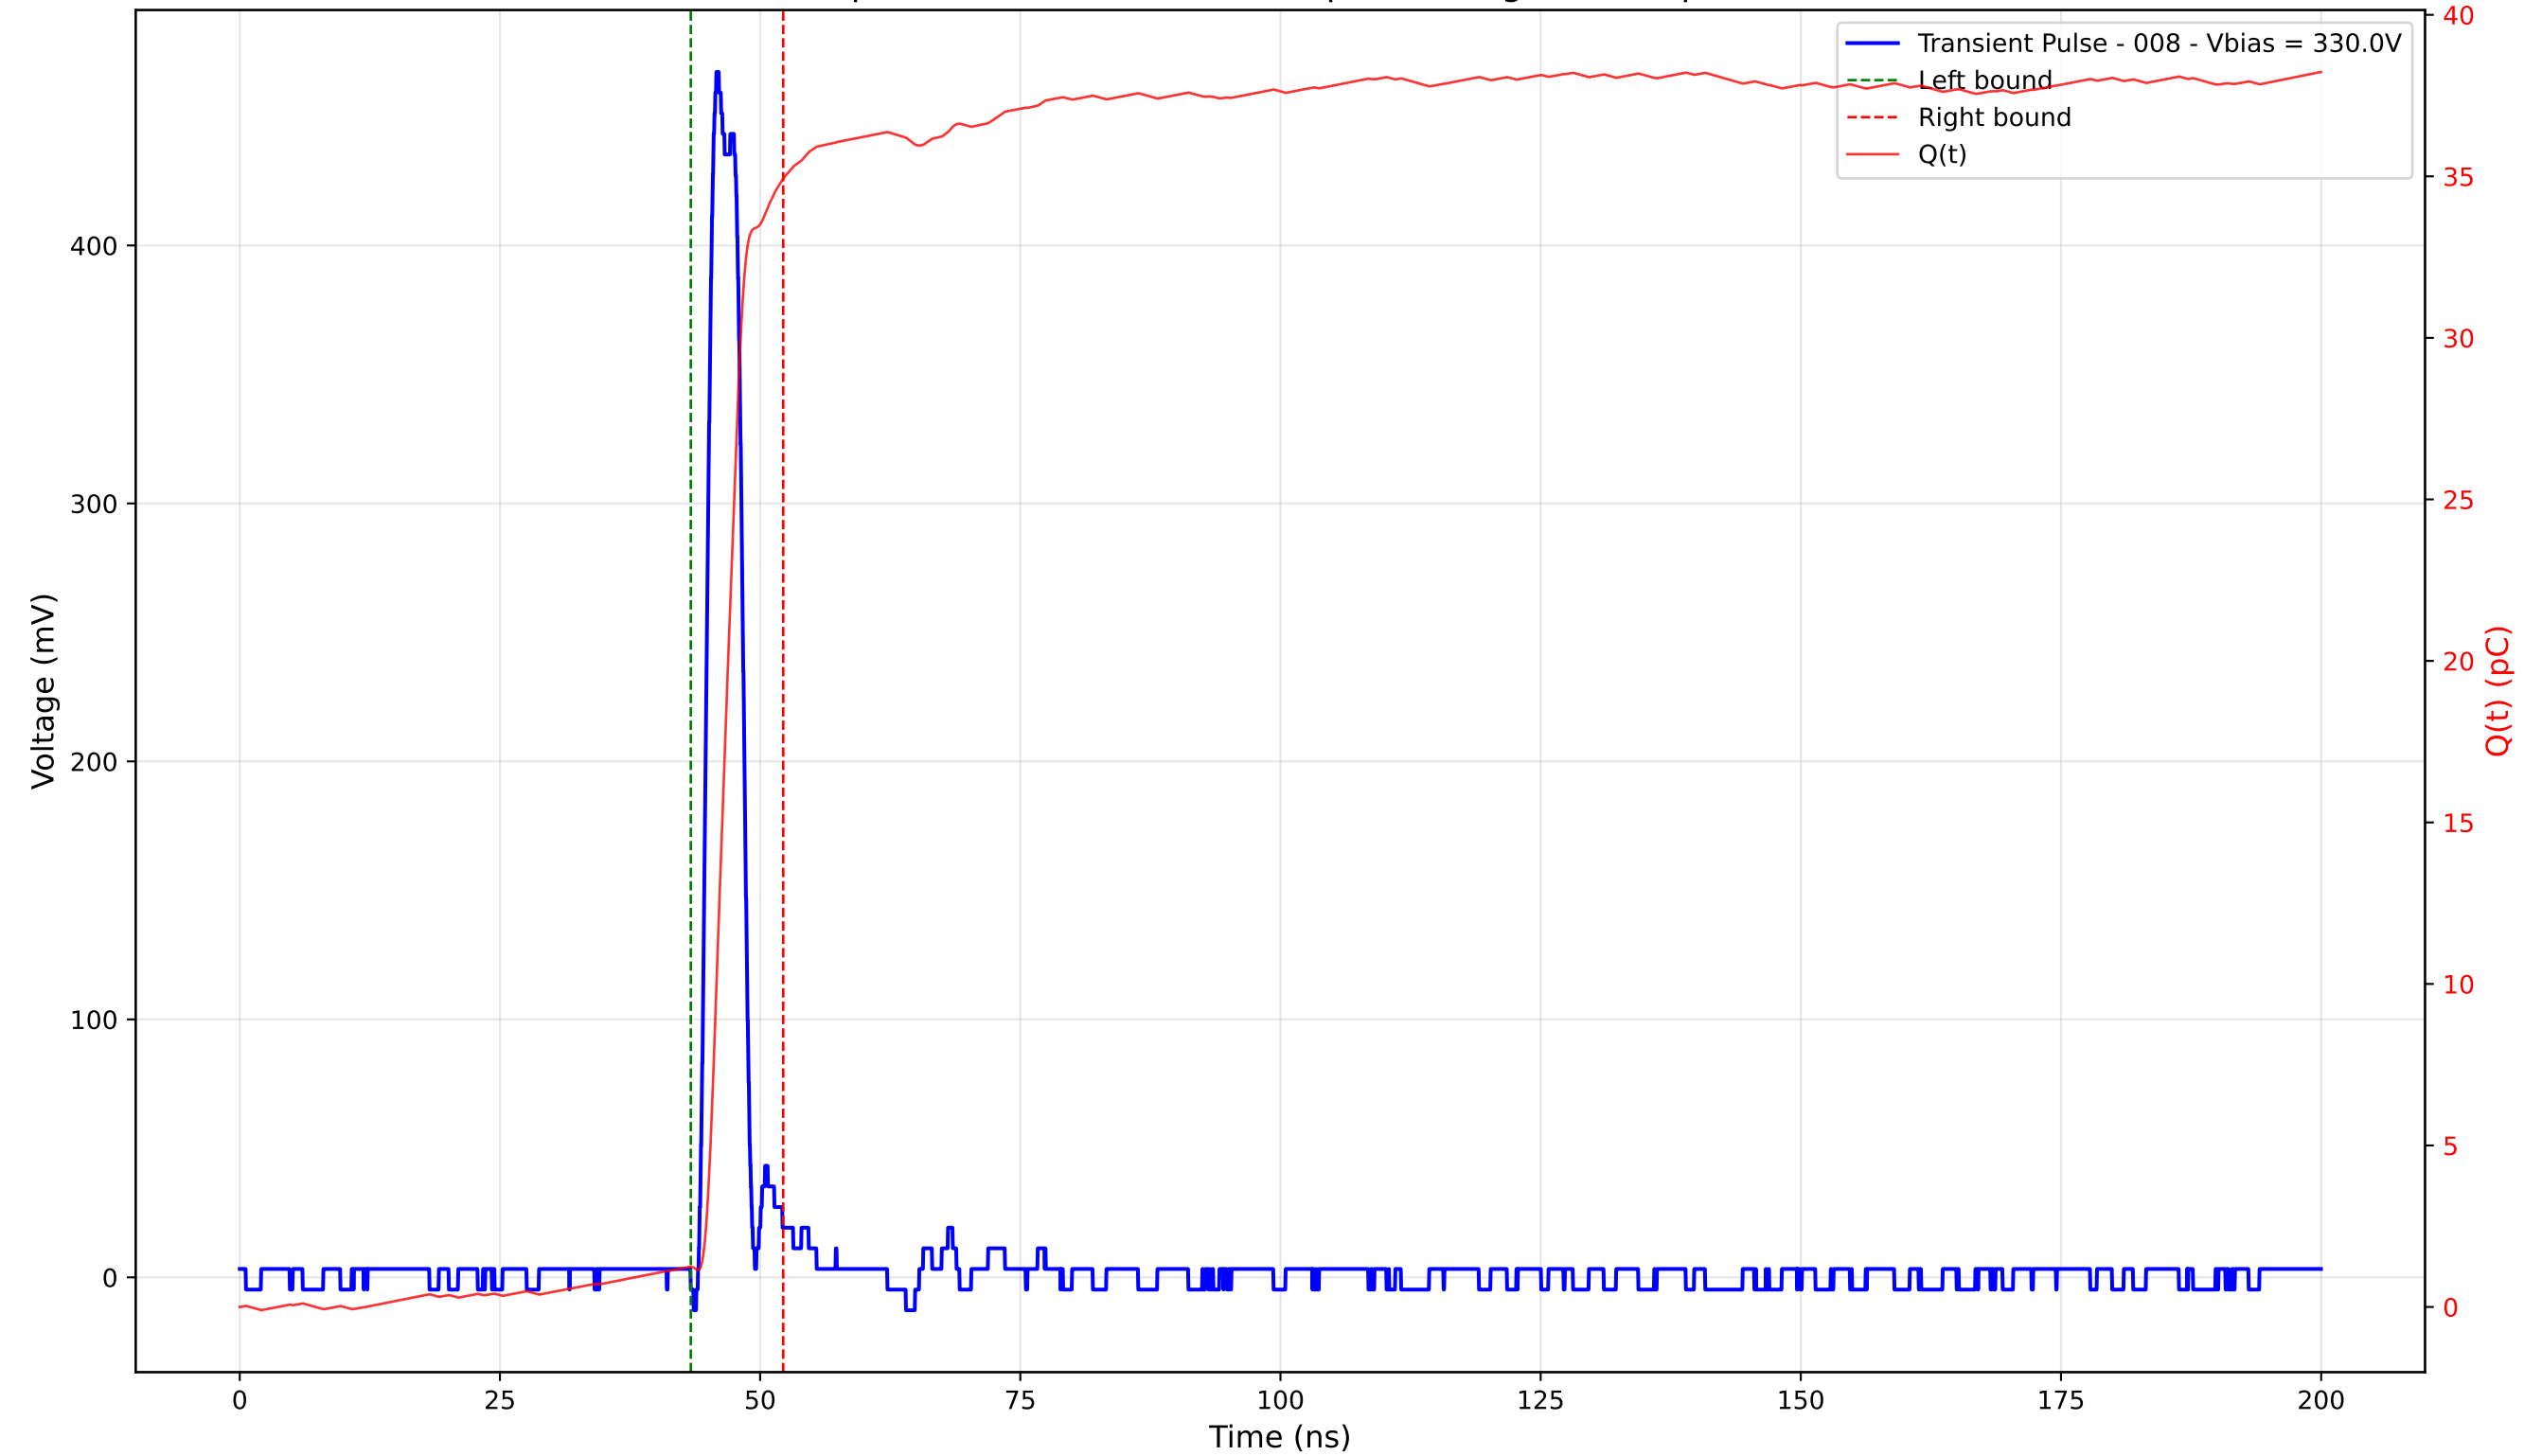


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 33.06 pC - Rise Time: 1.11 ns

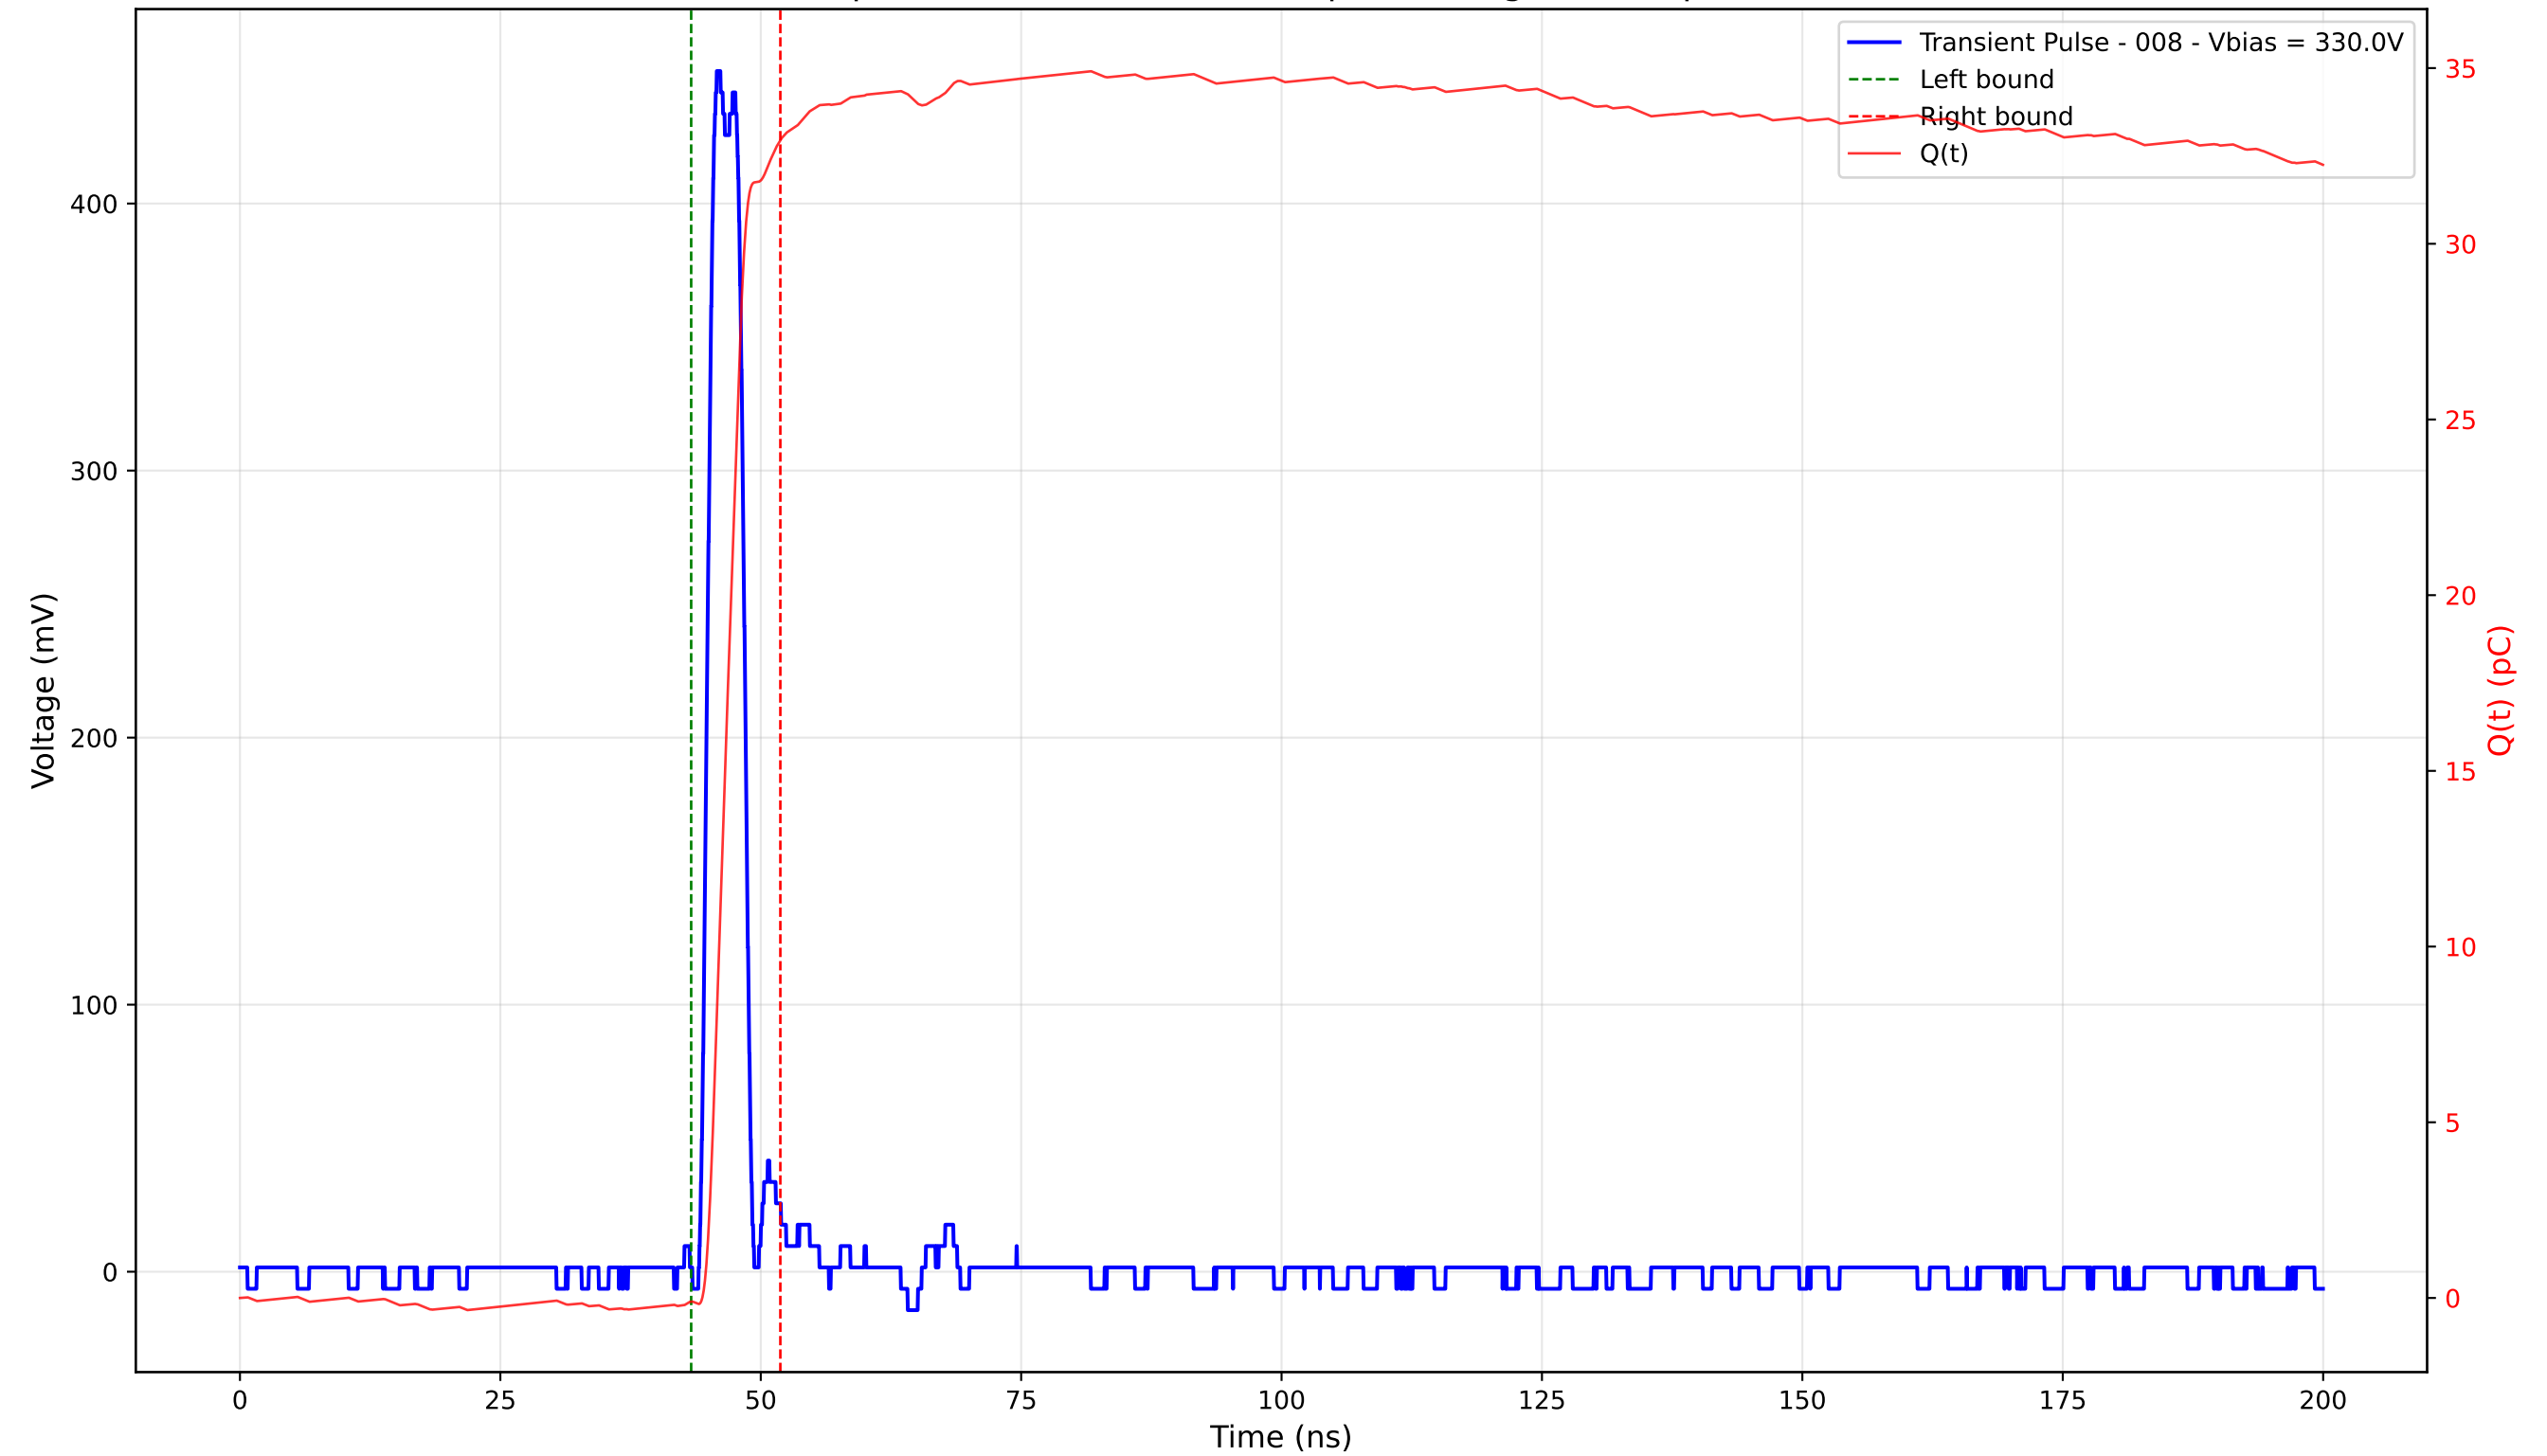


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 33.97 pC - Rise Time: 1.12 ns

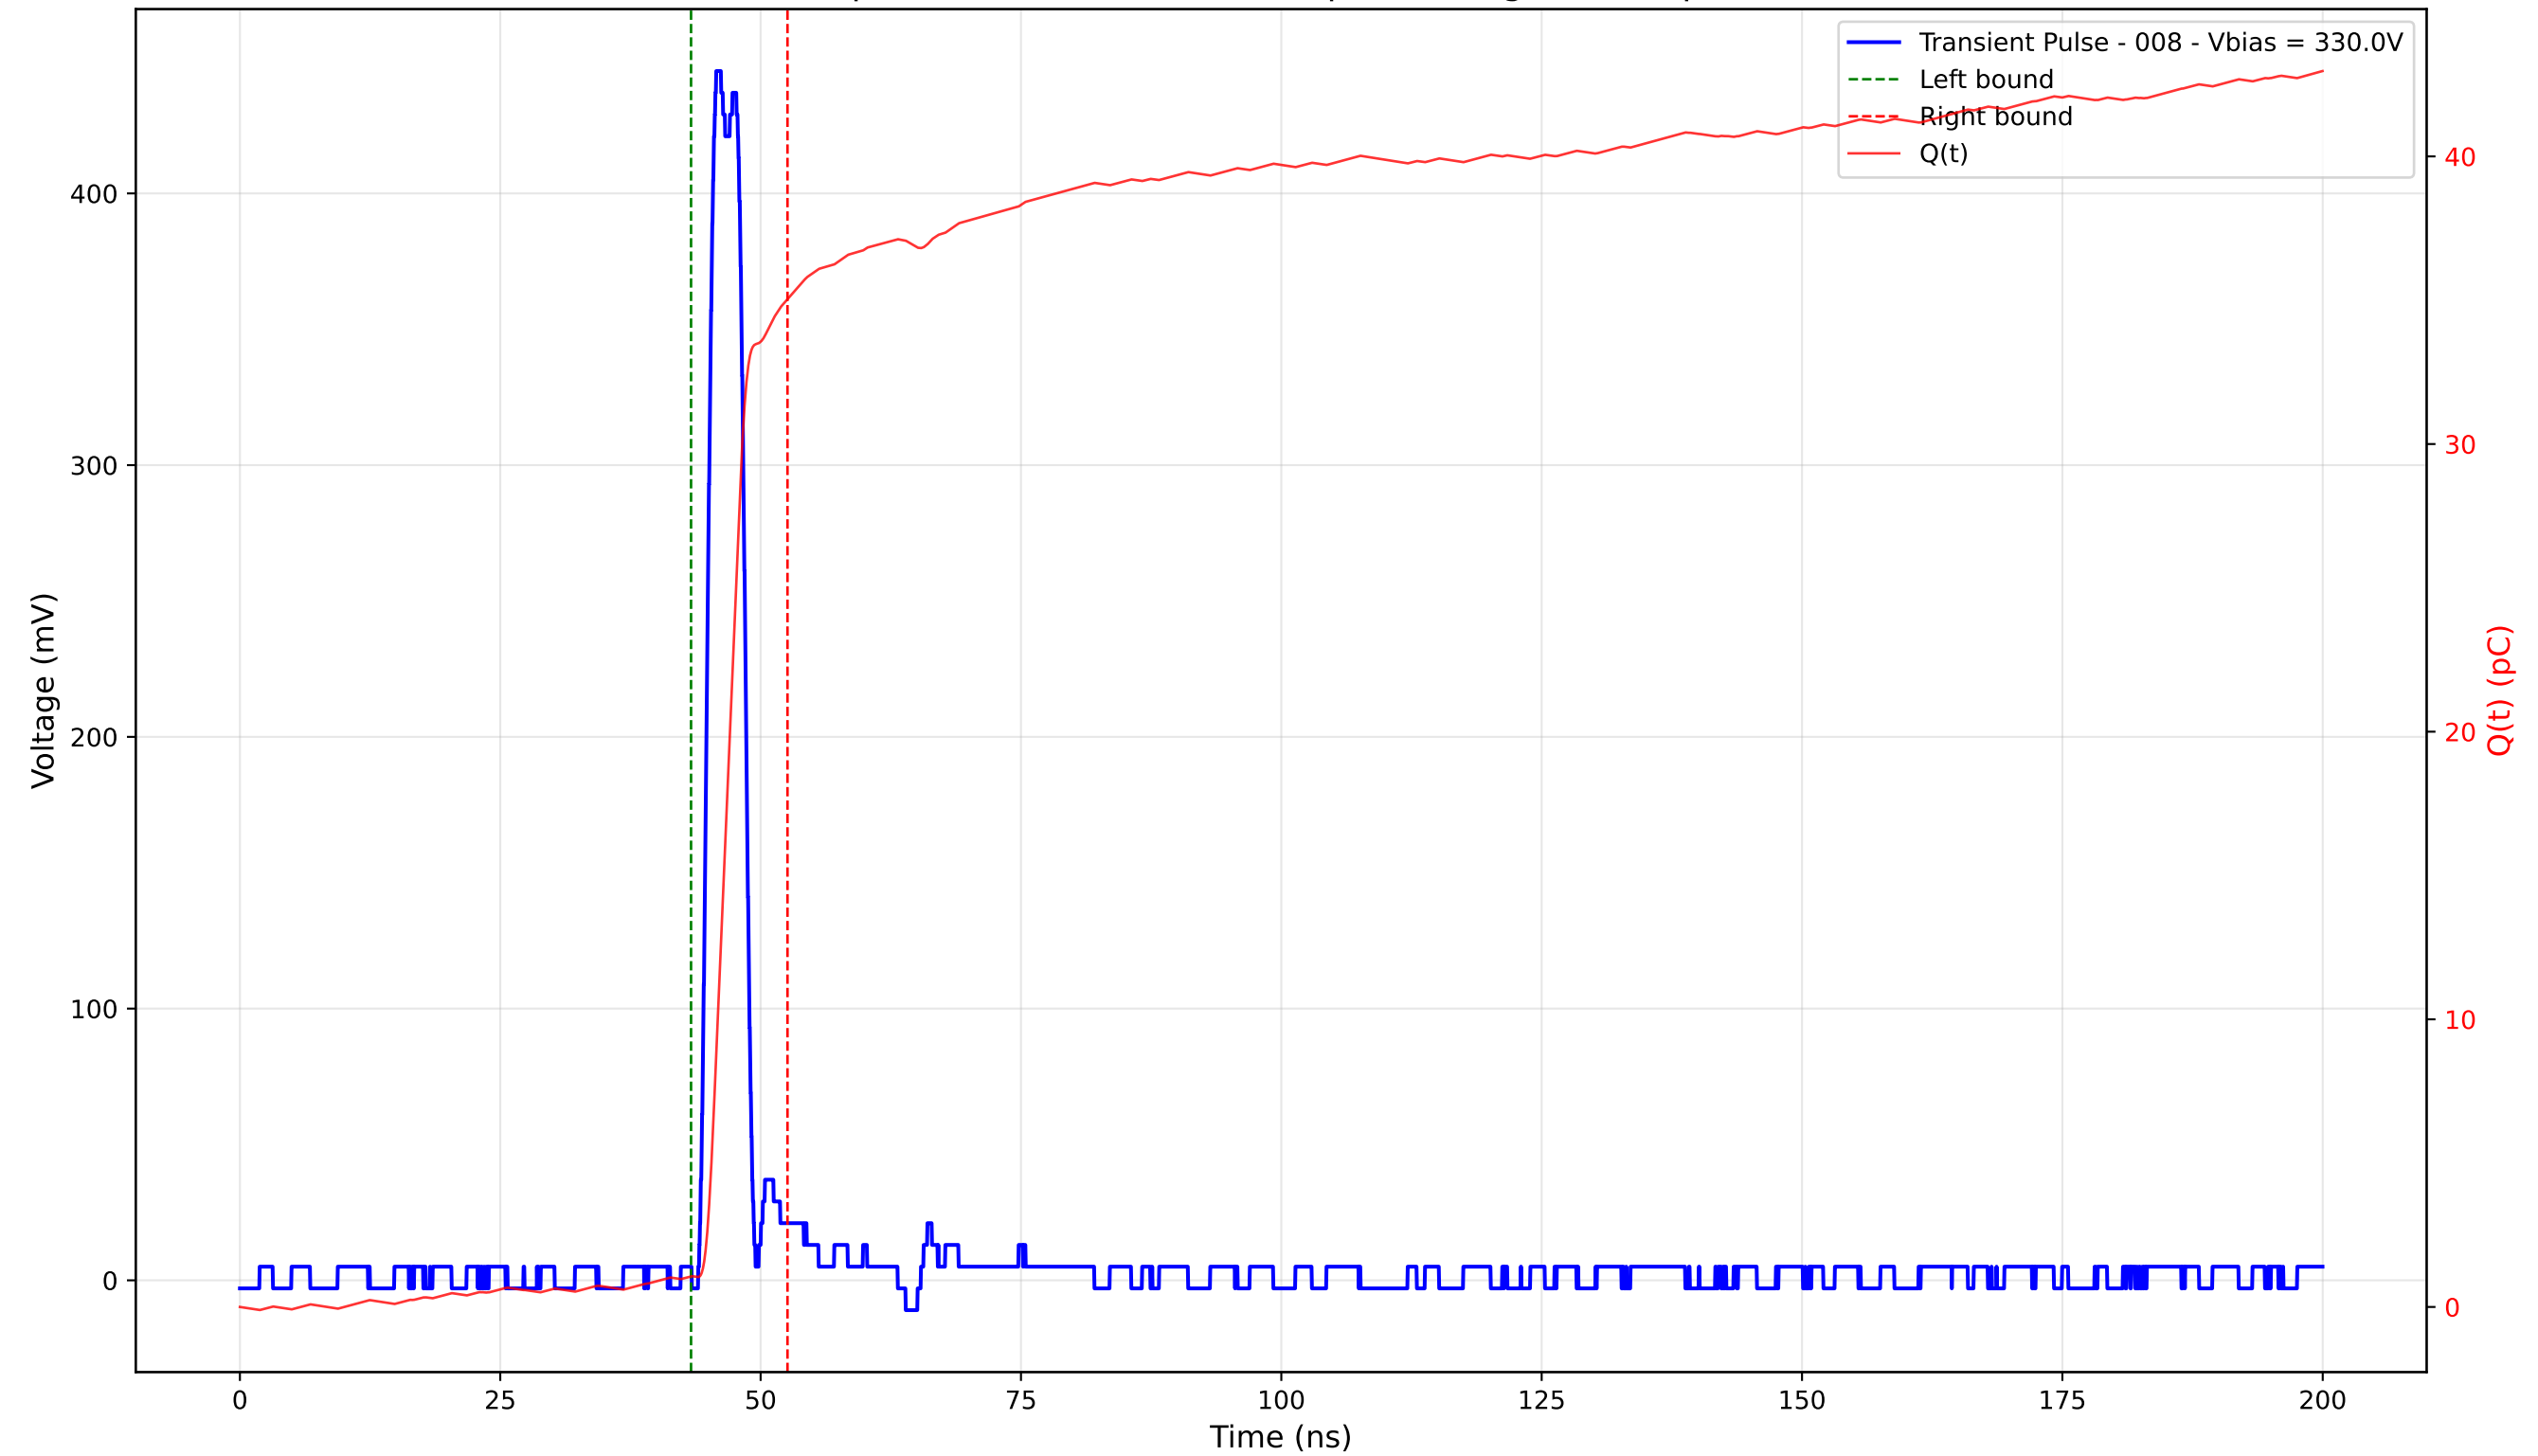


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 33.61 pC - Rise Time: 1.16 ns

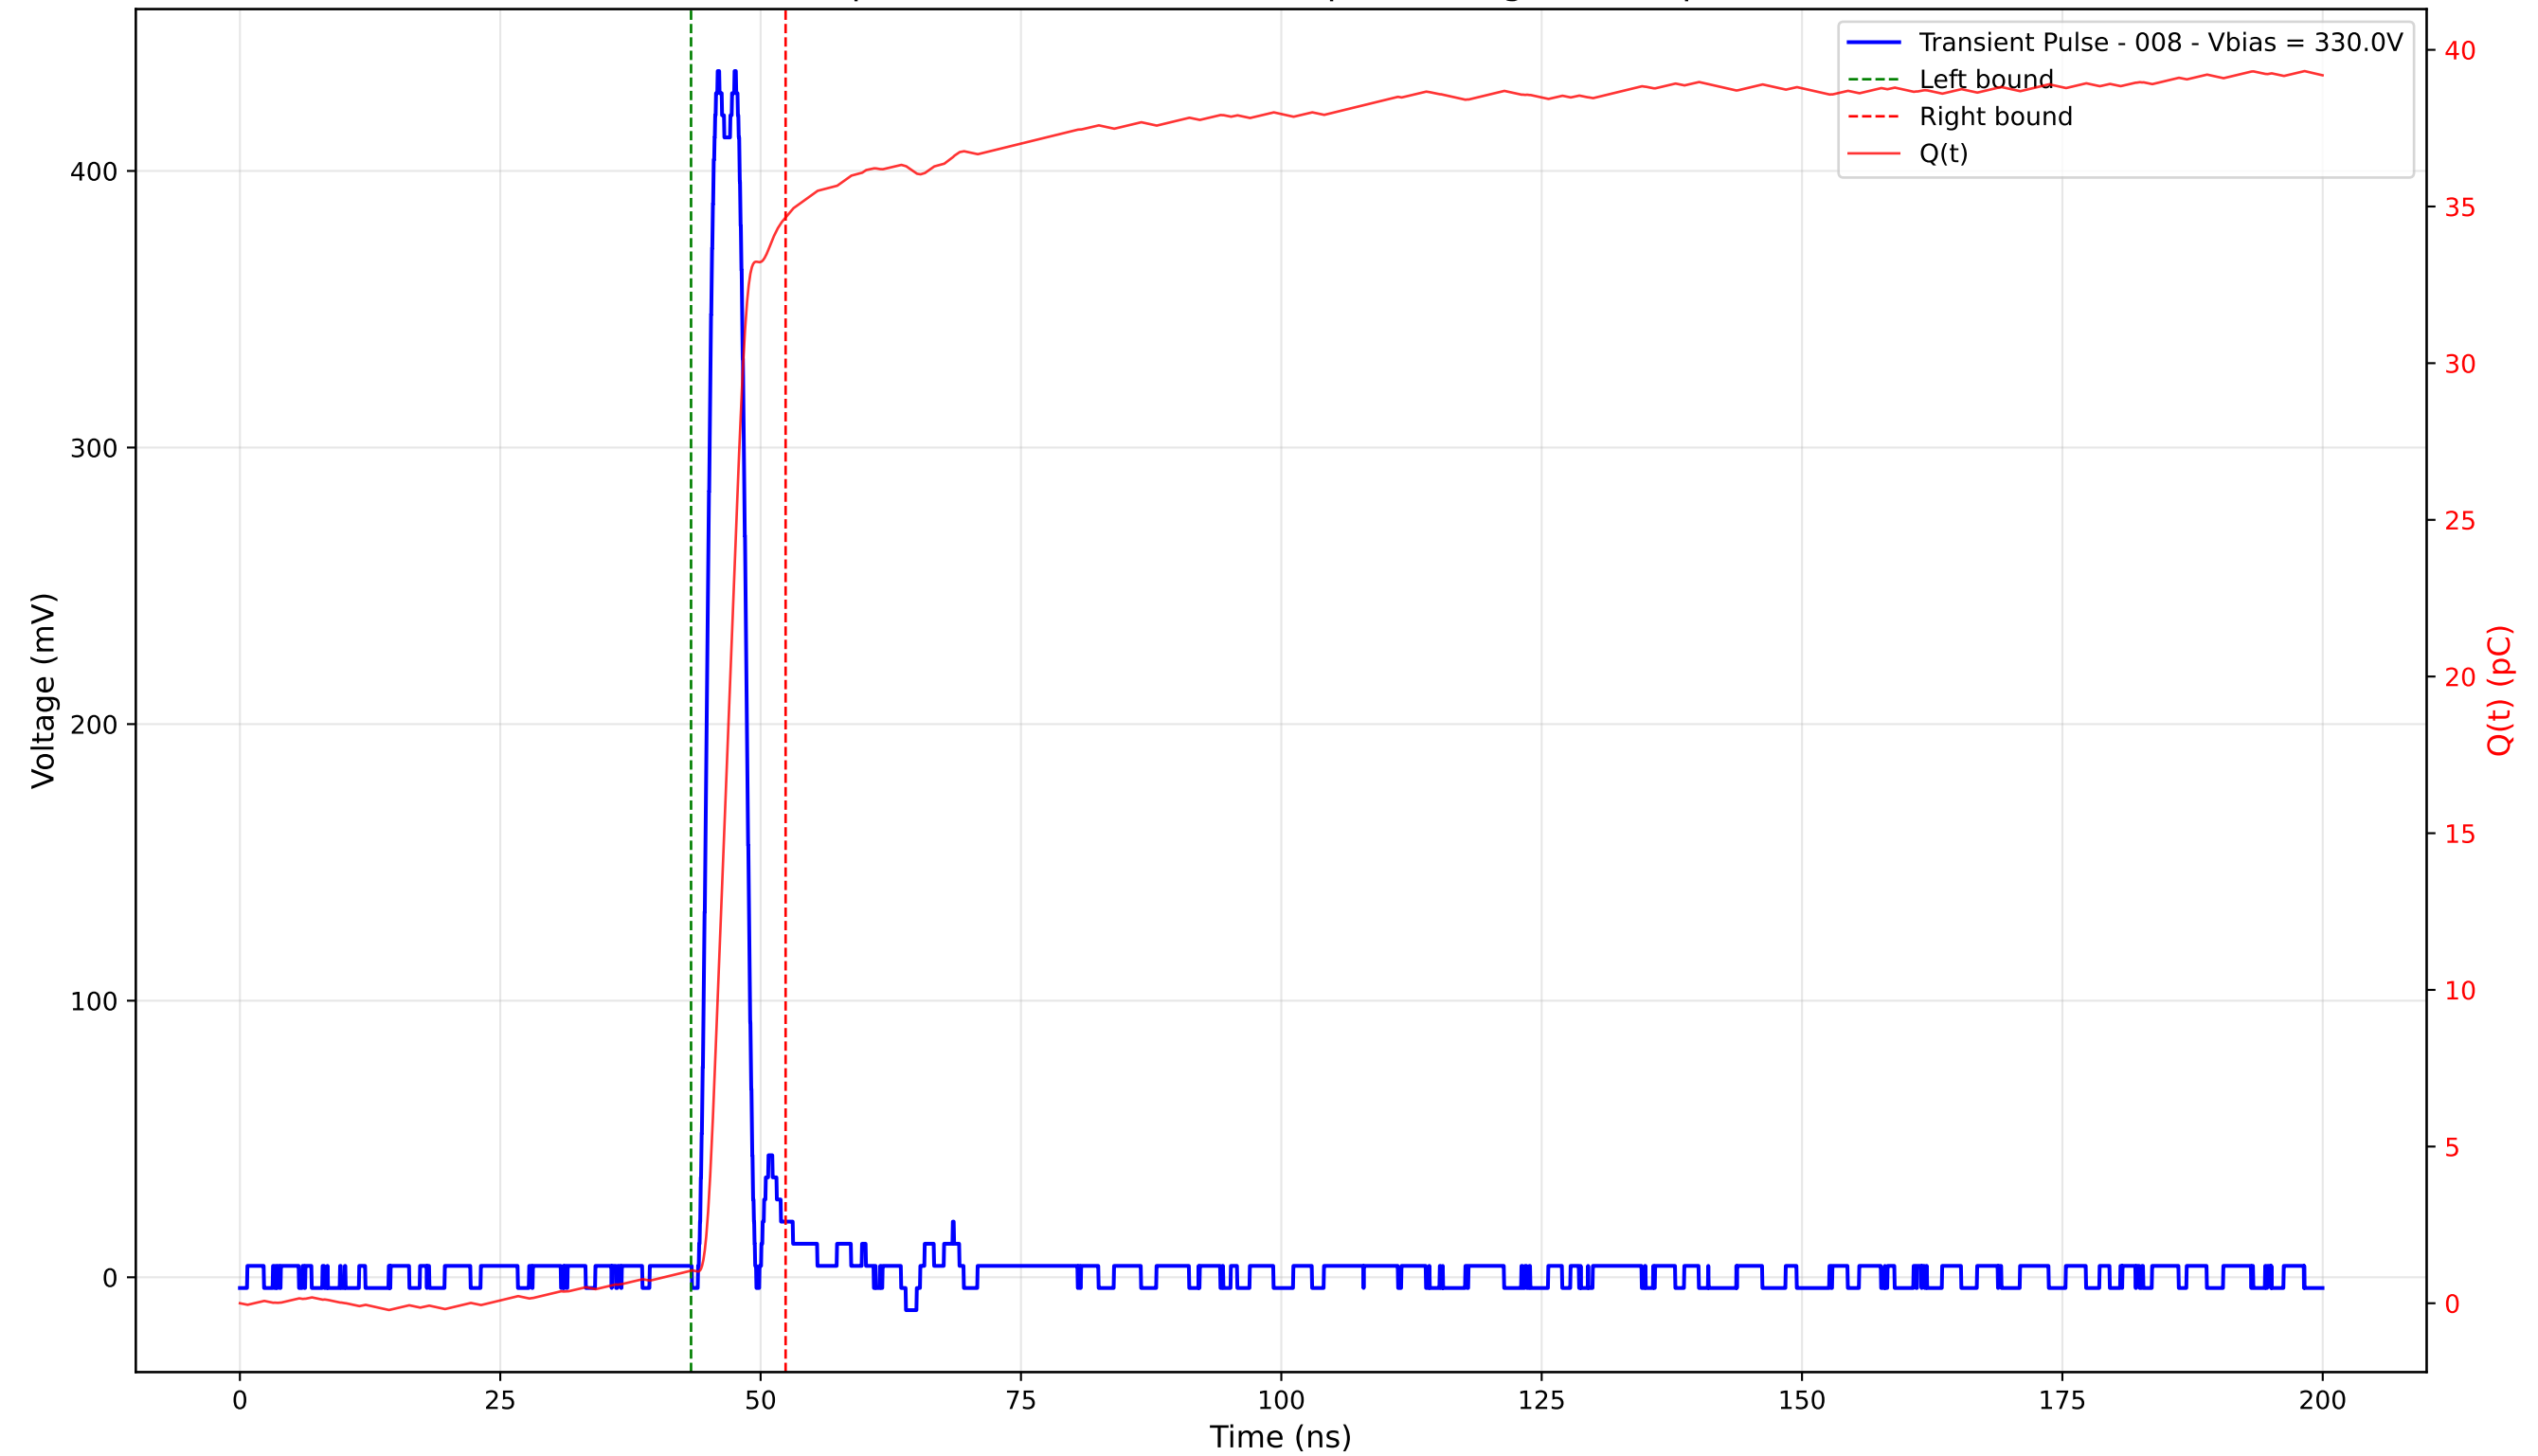


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 31.77 pC - Rise Time: 1.10 ns

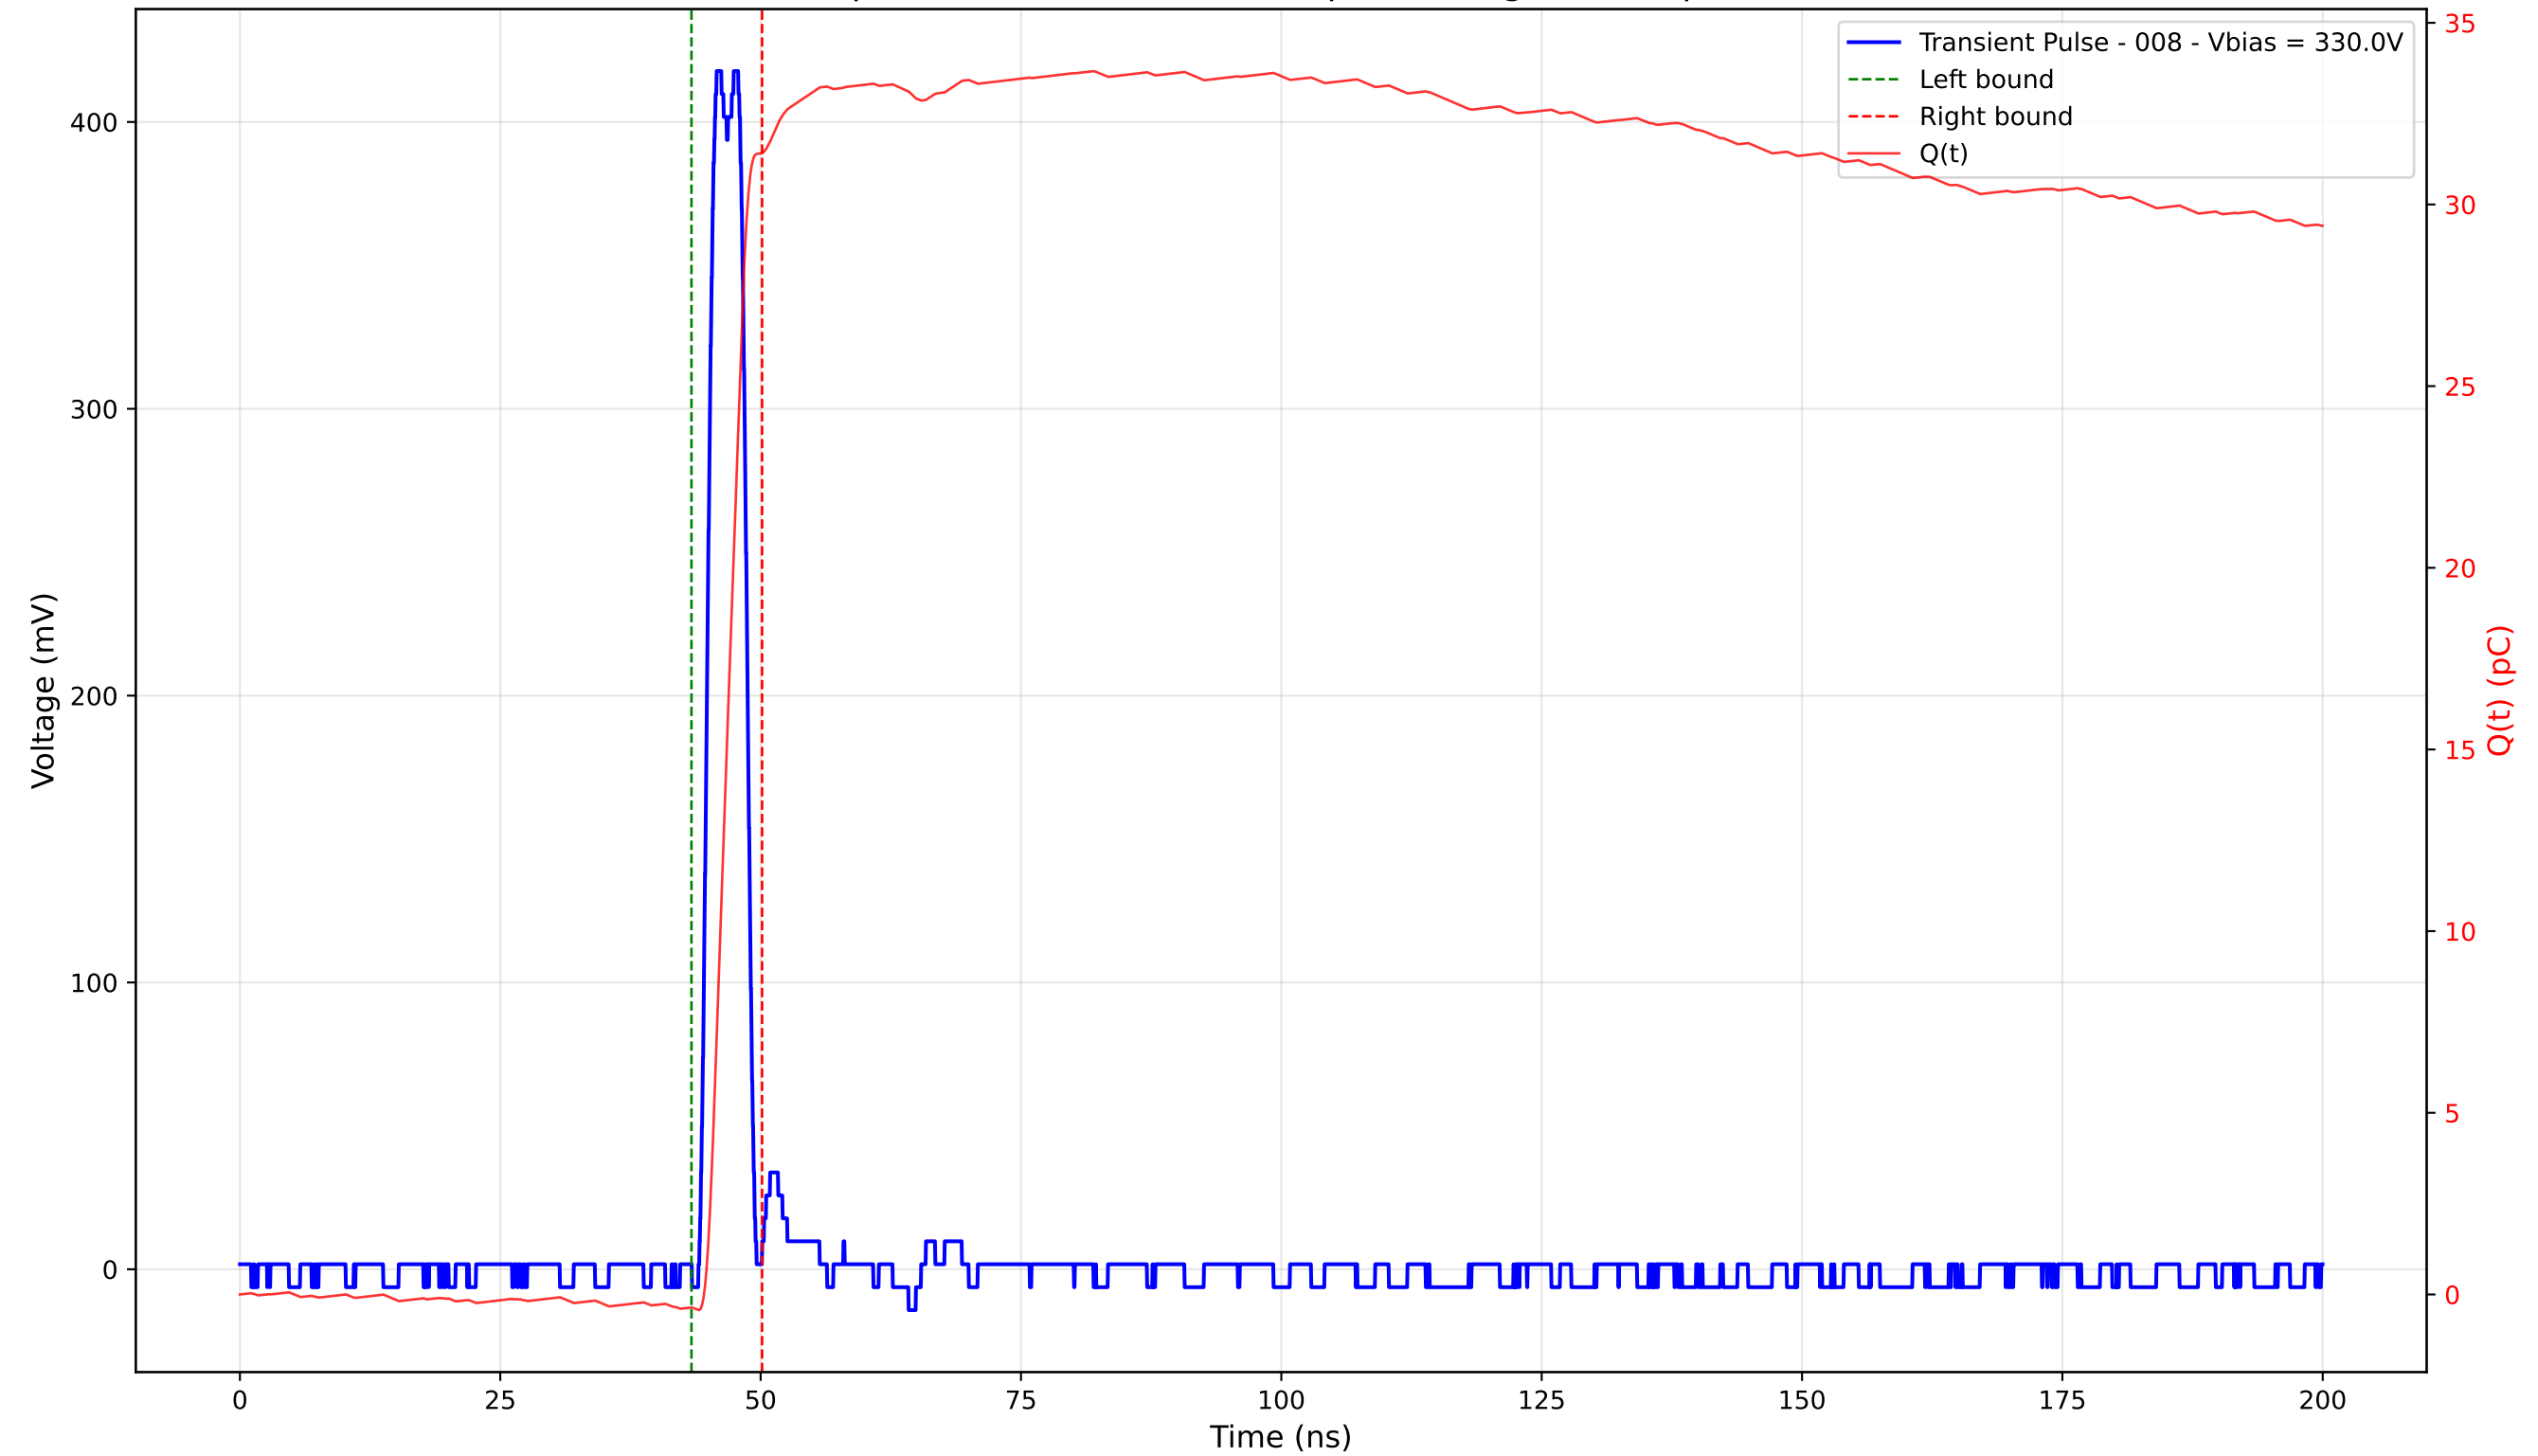


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 31.54 pC - Rise Time: 1.16 ns

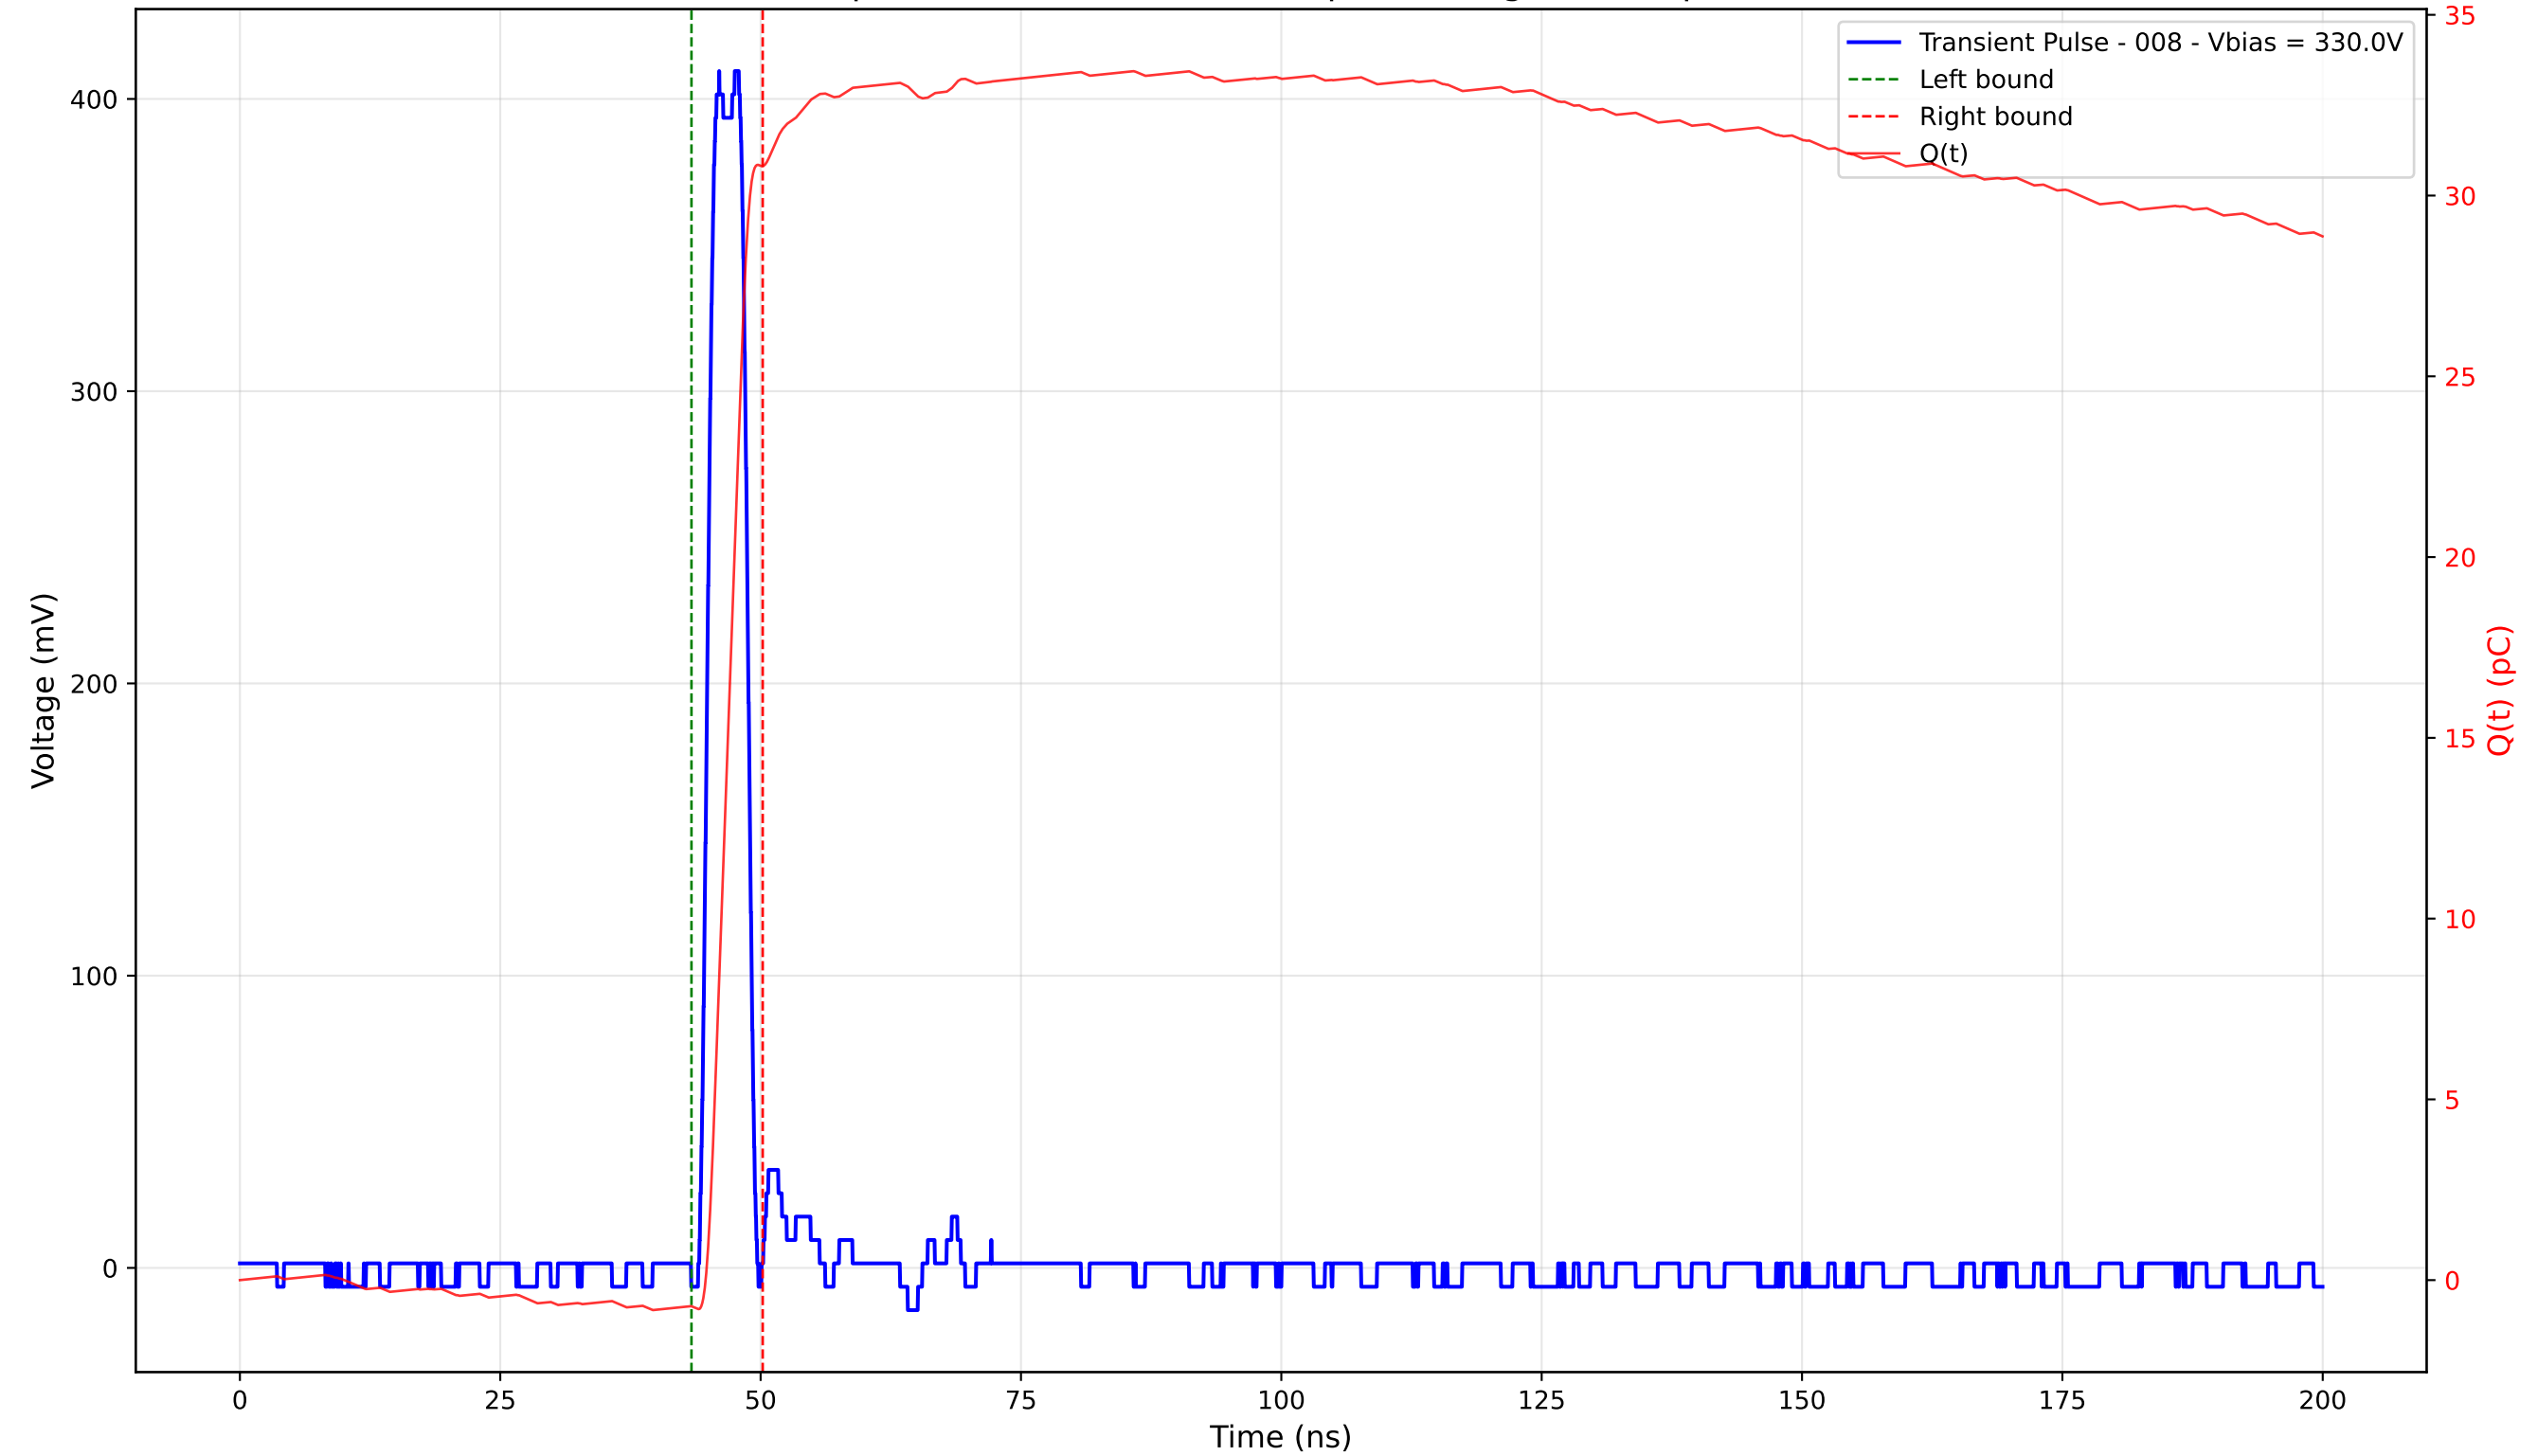


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 33.19 pC - Rise Time: 1.23 ns

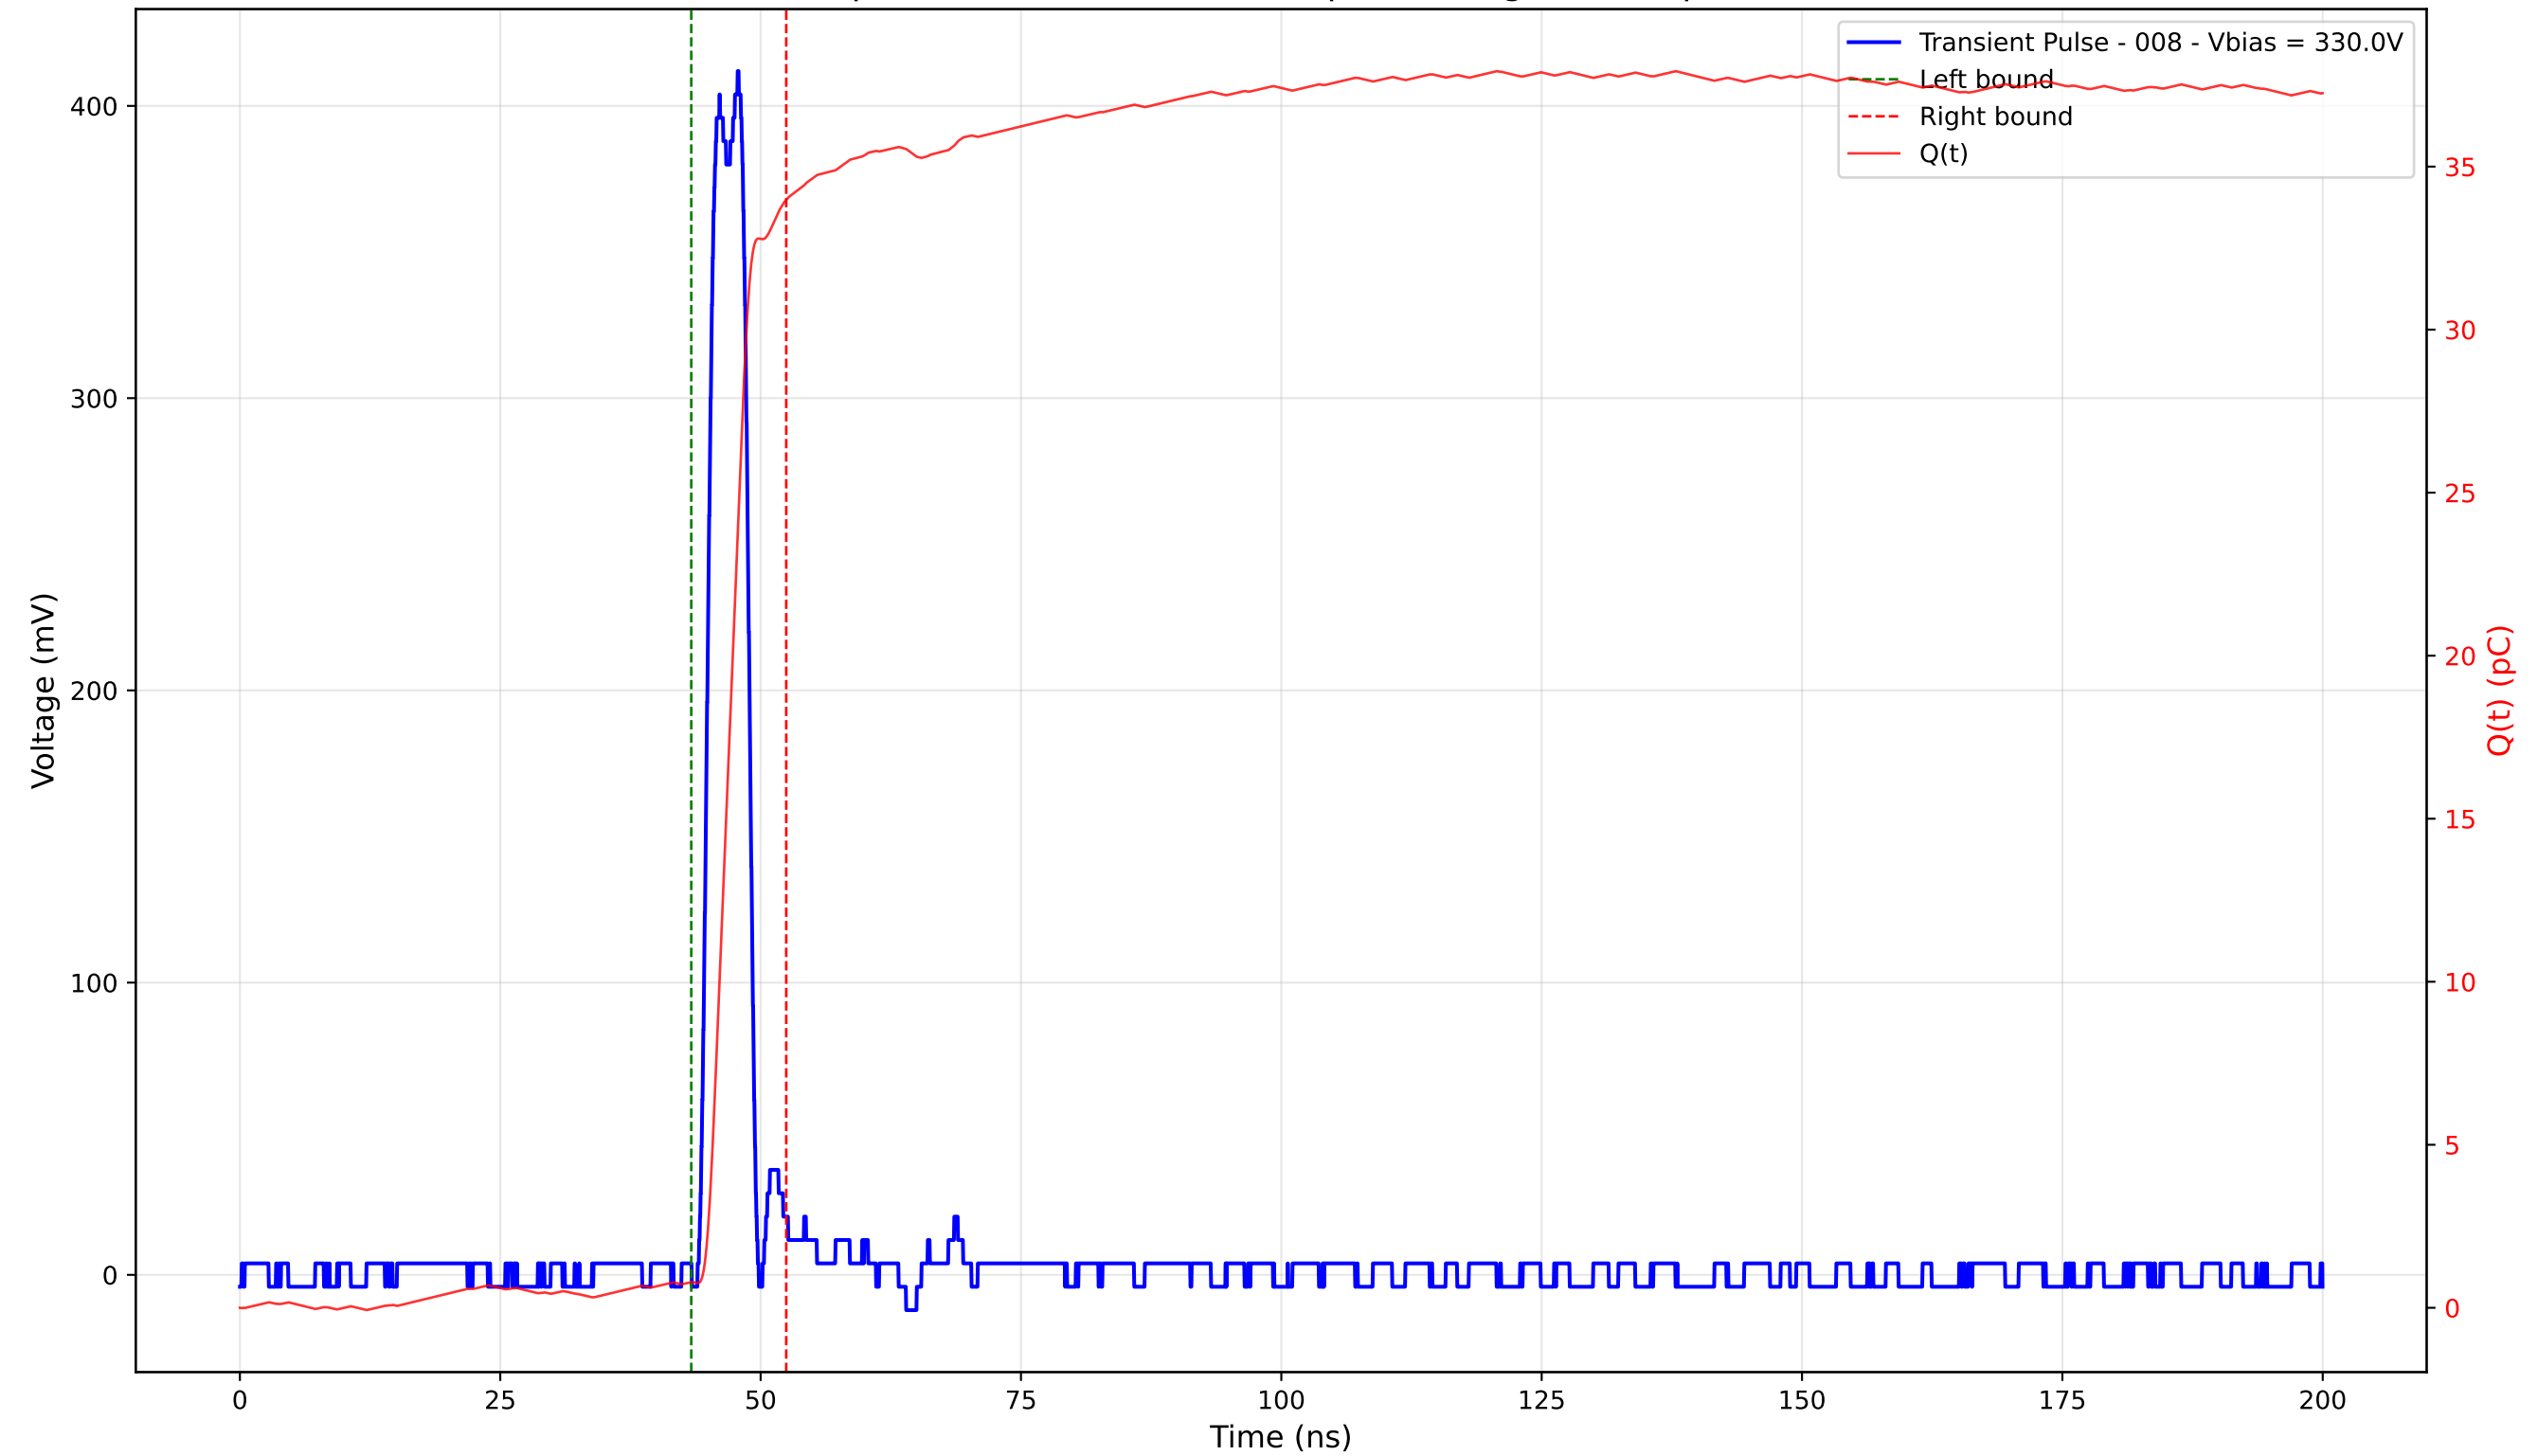


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 31.67 pC - Rise Time: 1.20 ns

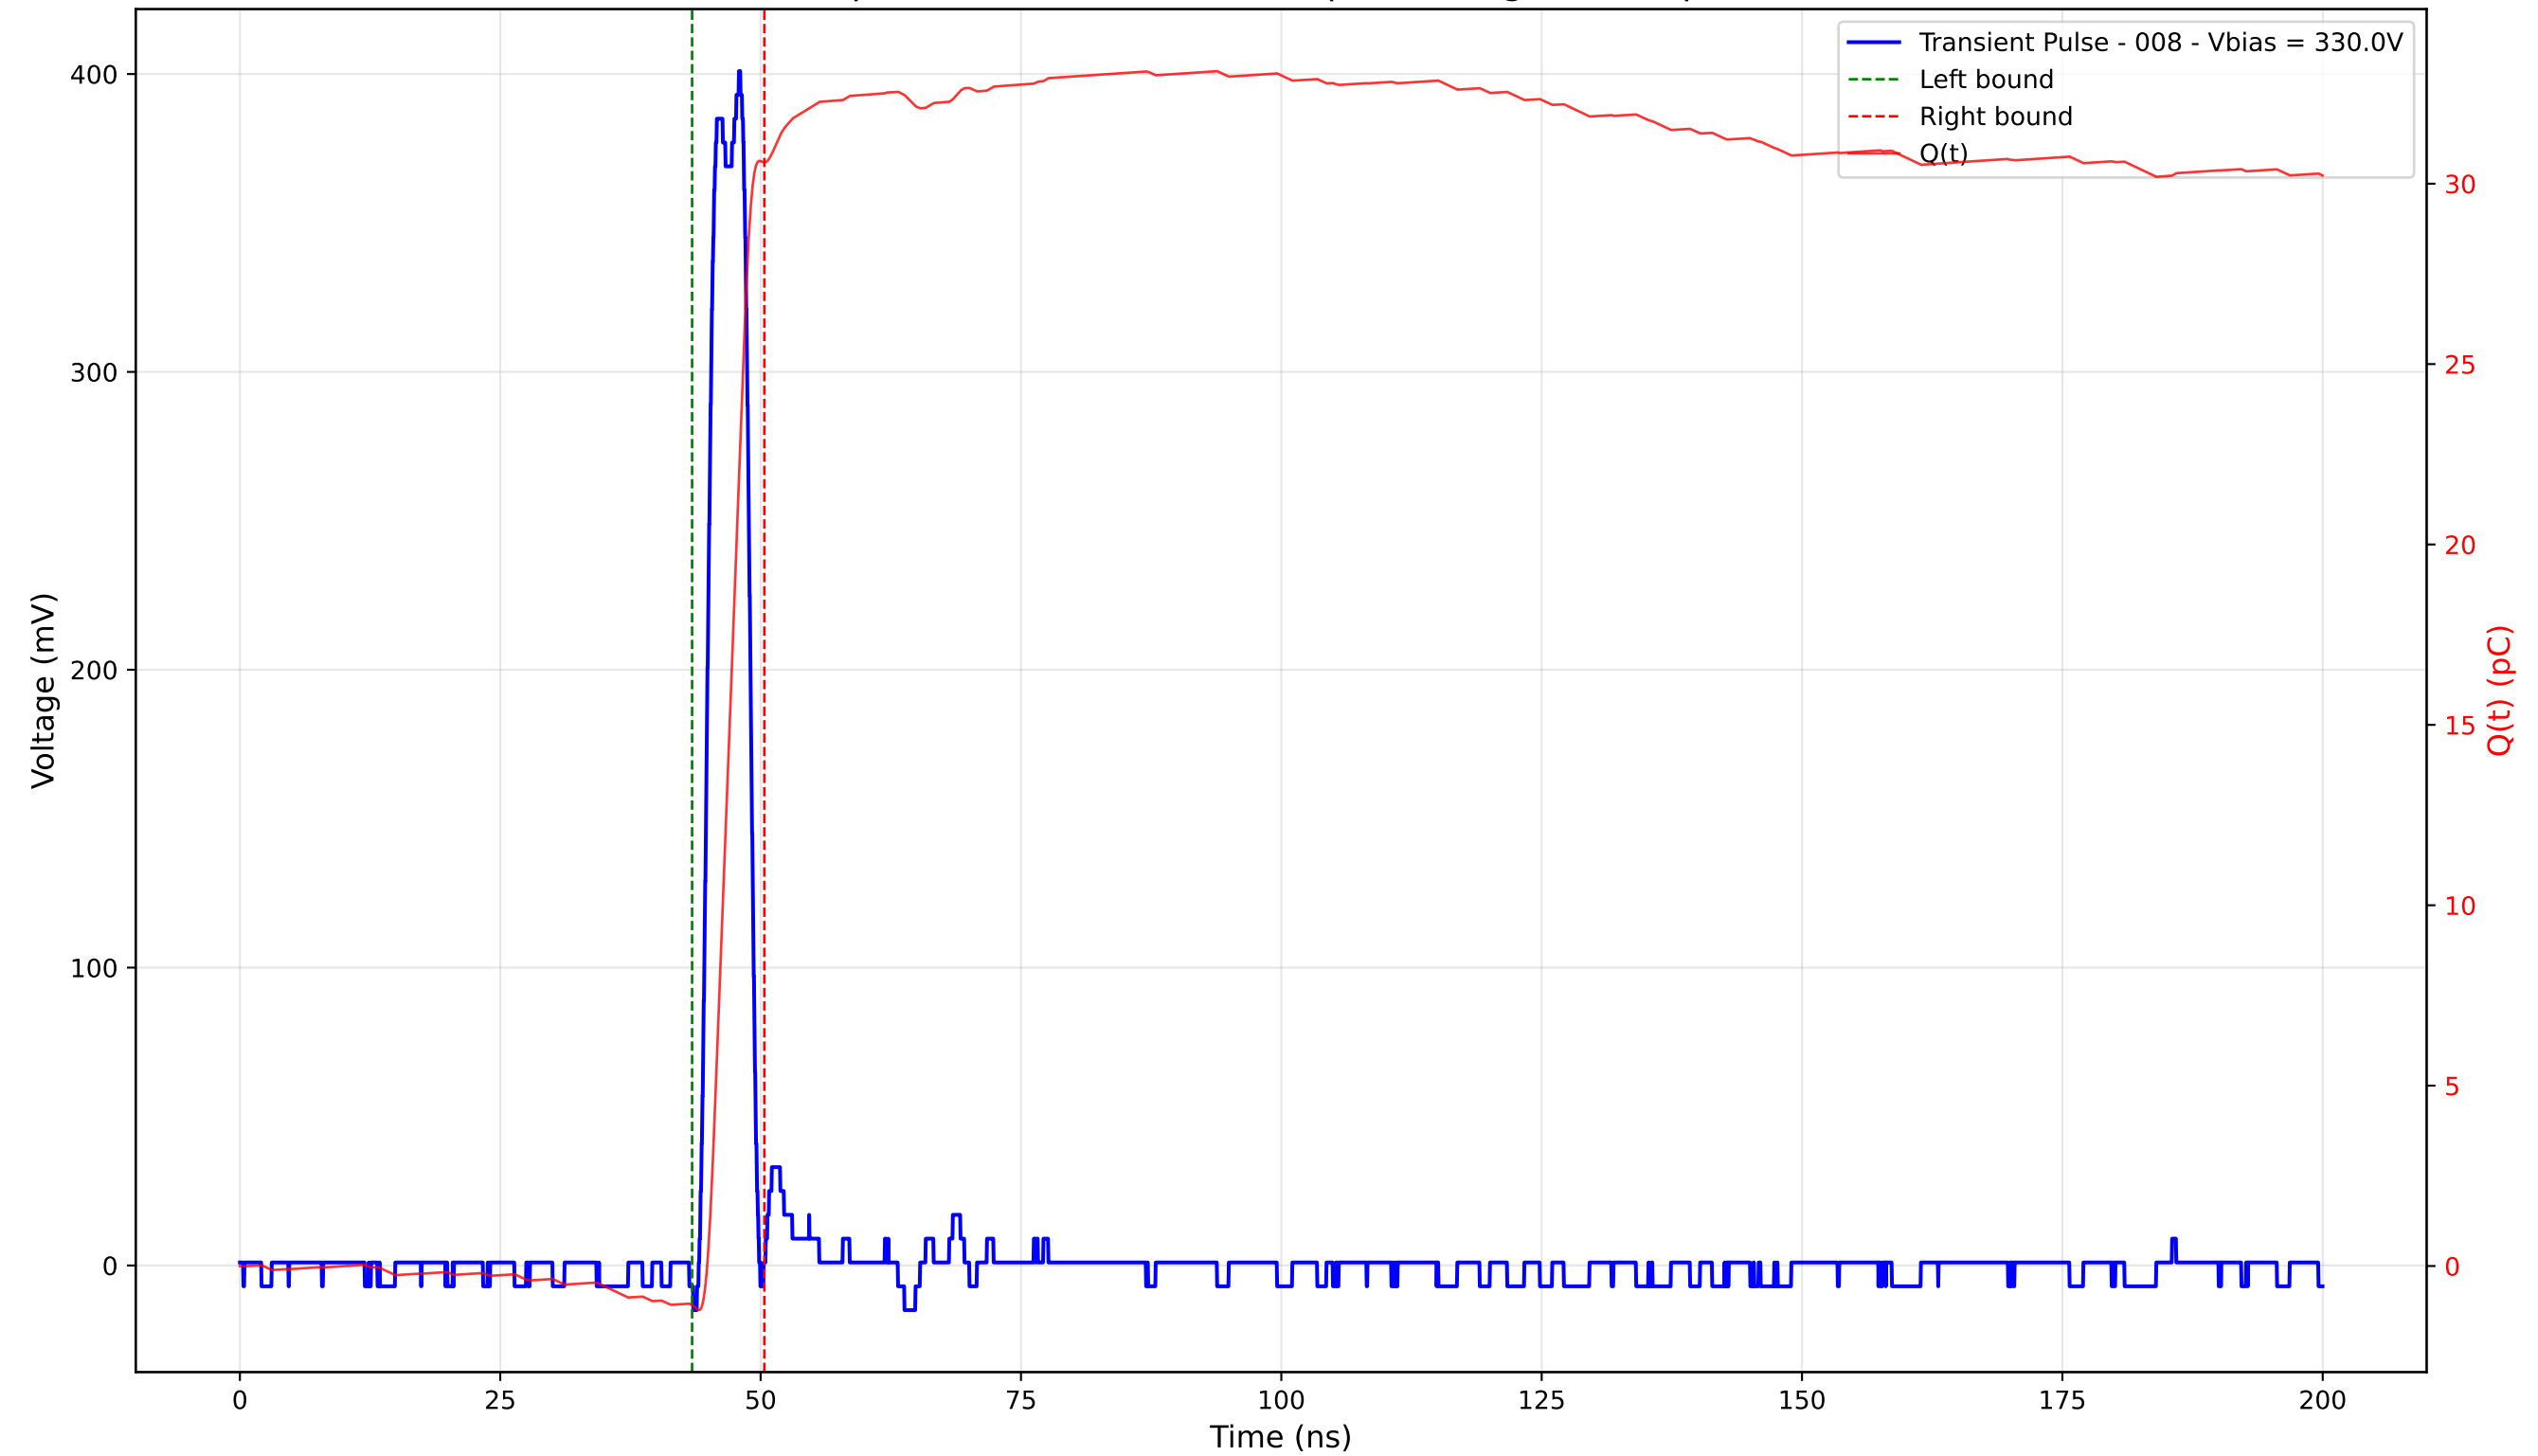


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 33.30 pC - Rise Time: 1.33 ns

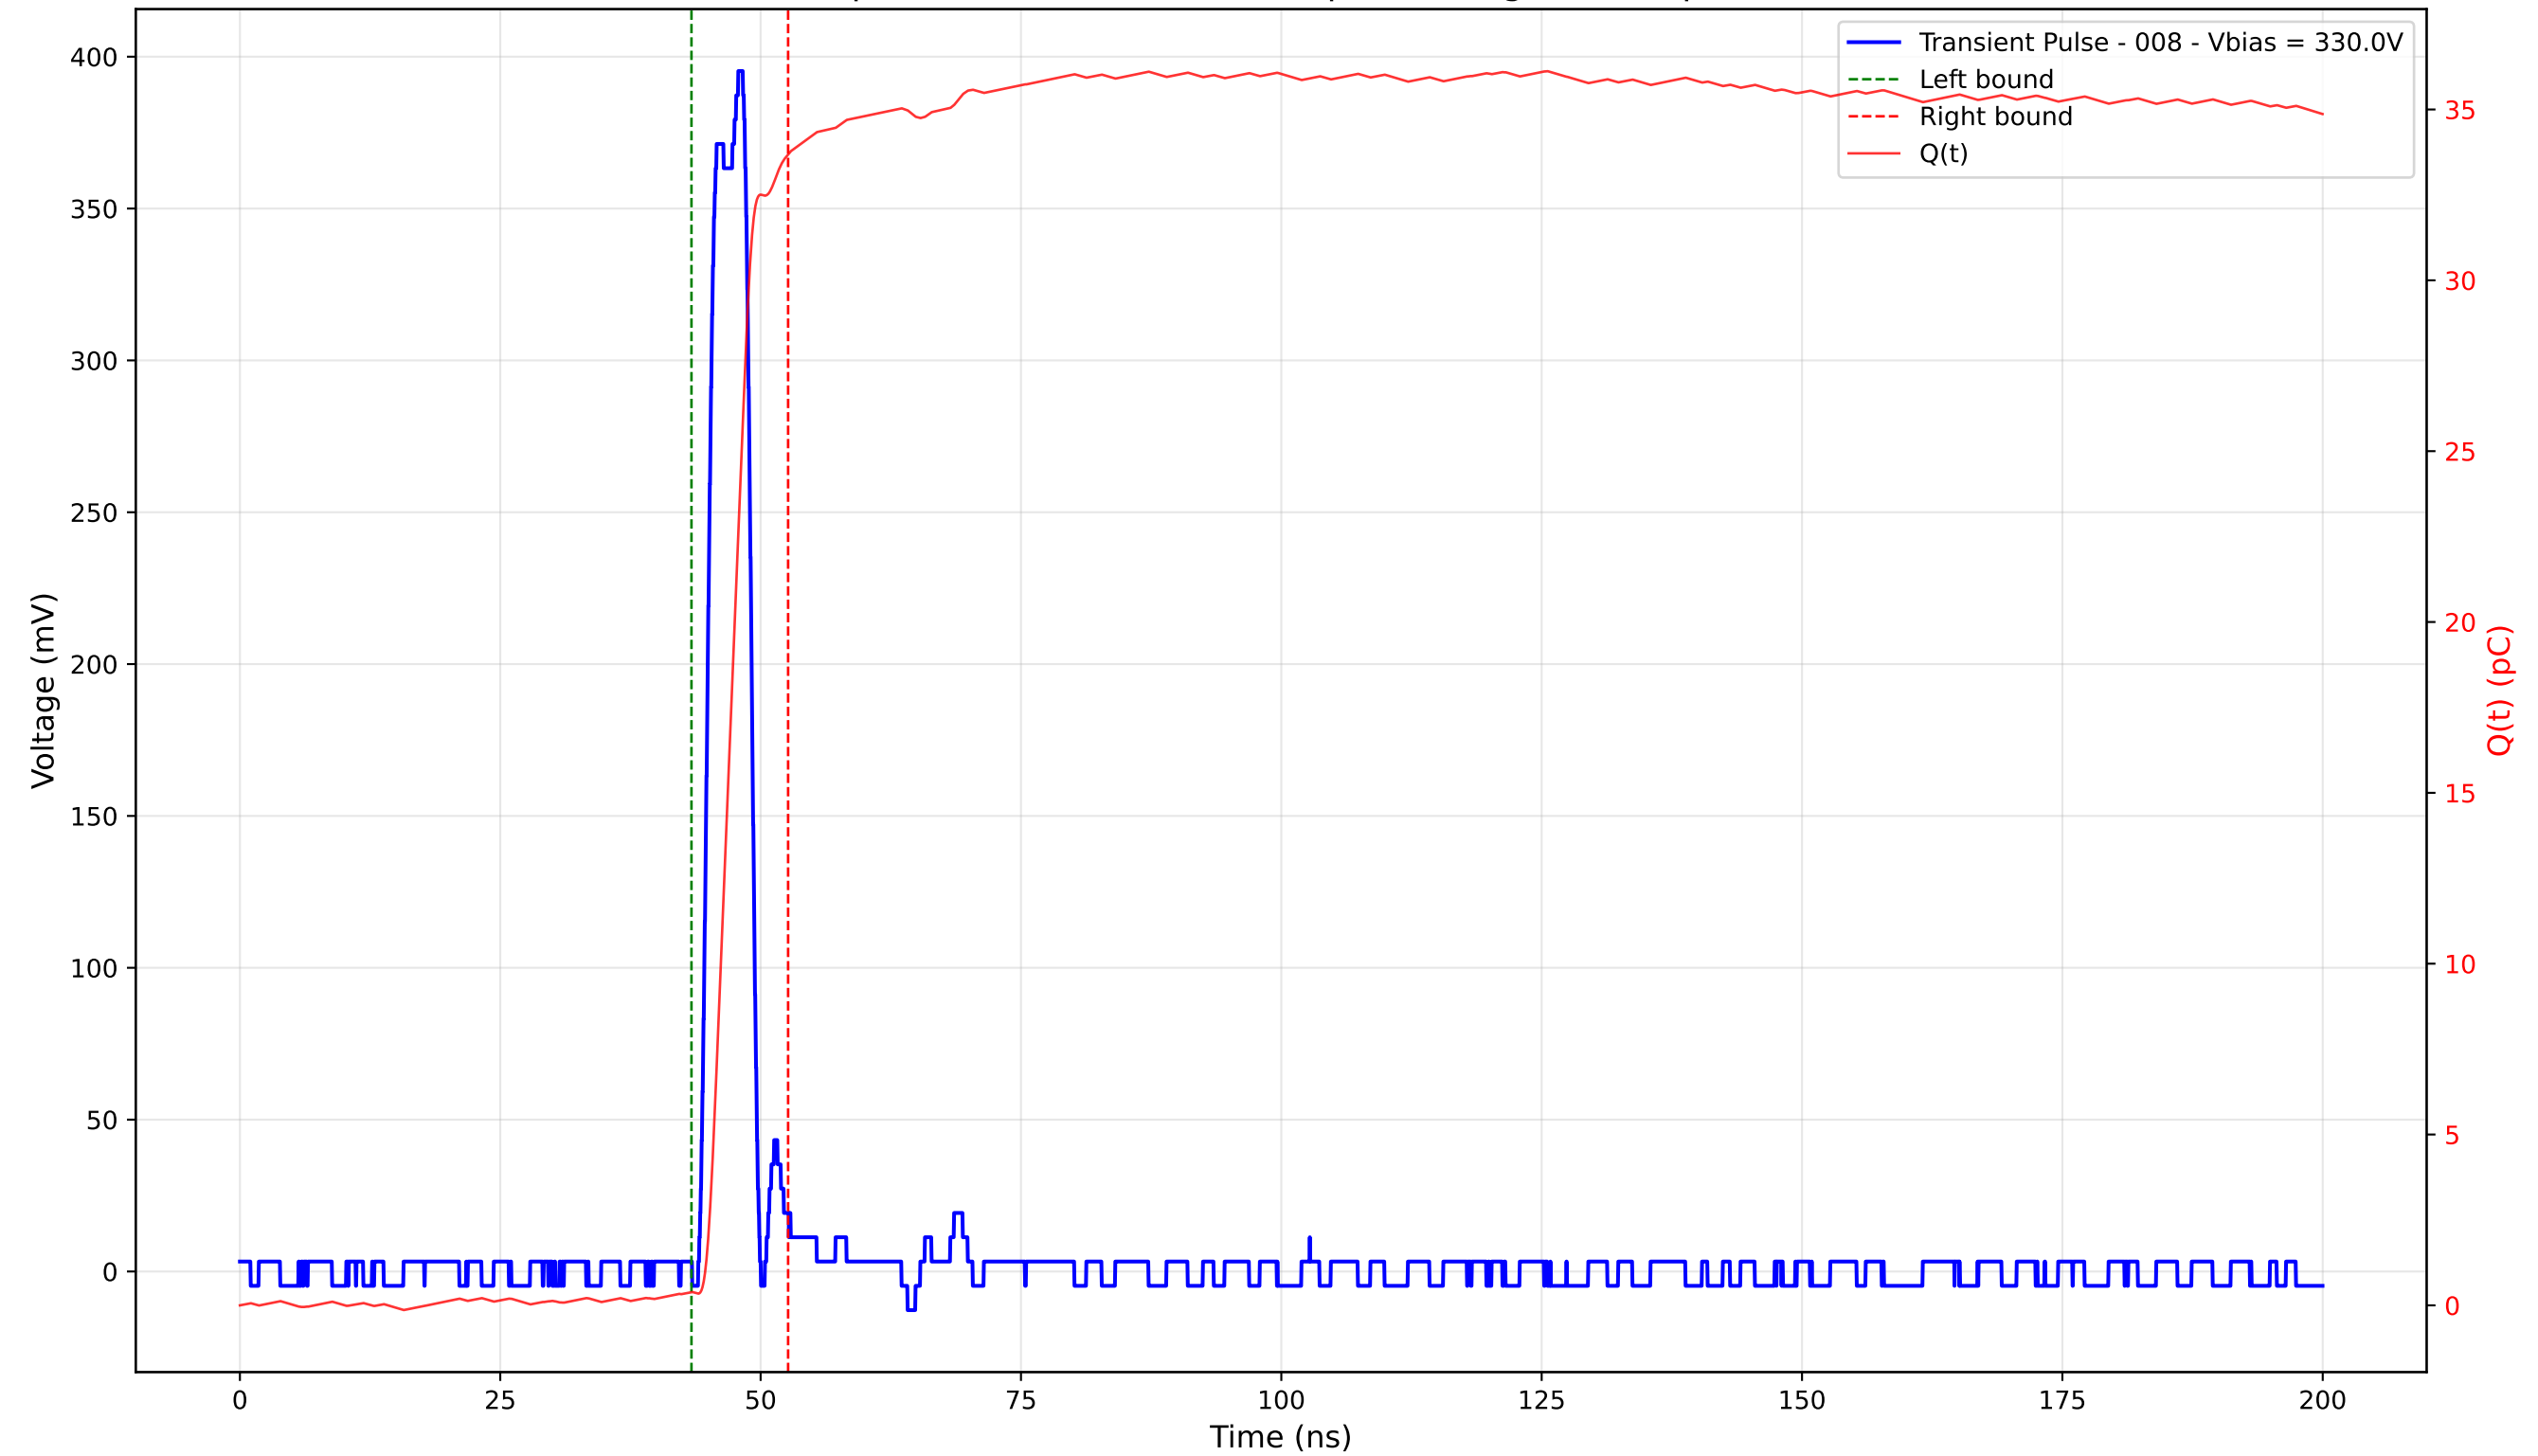


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 31.36 pC - Rise Time: 1.47 ns

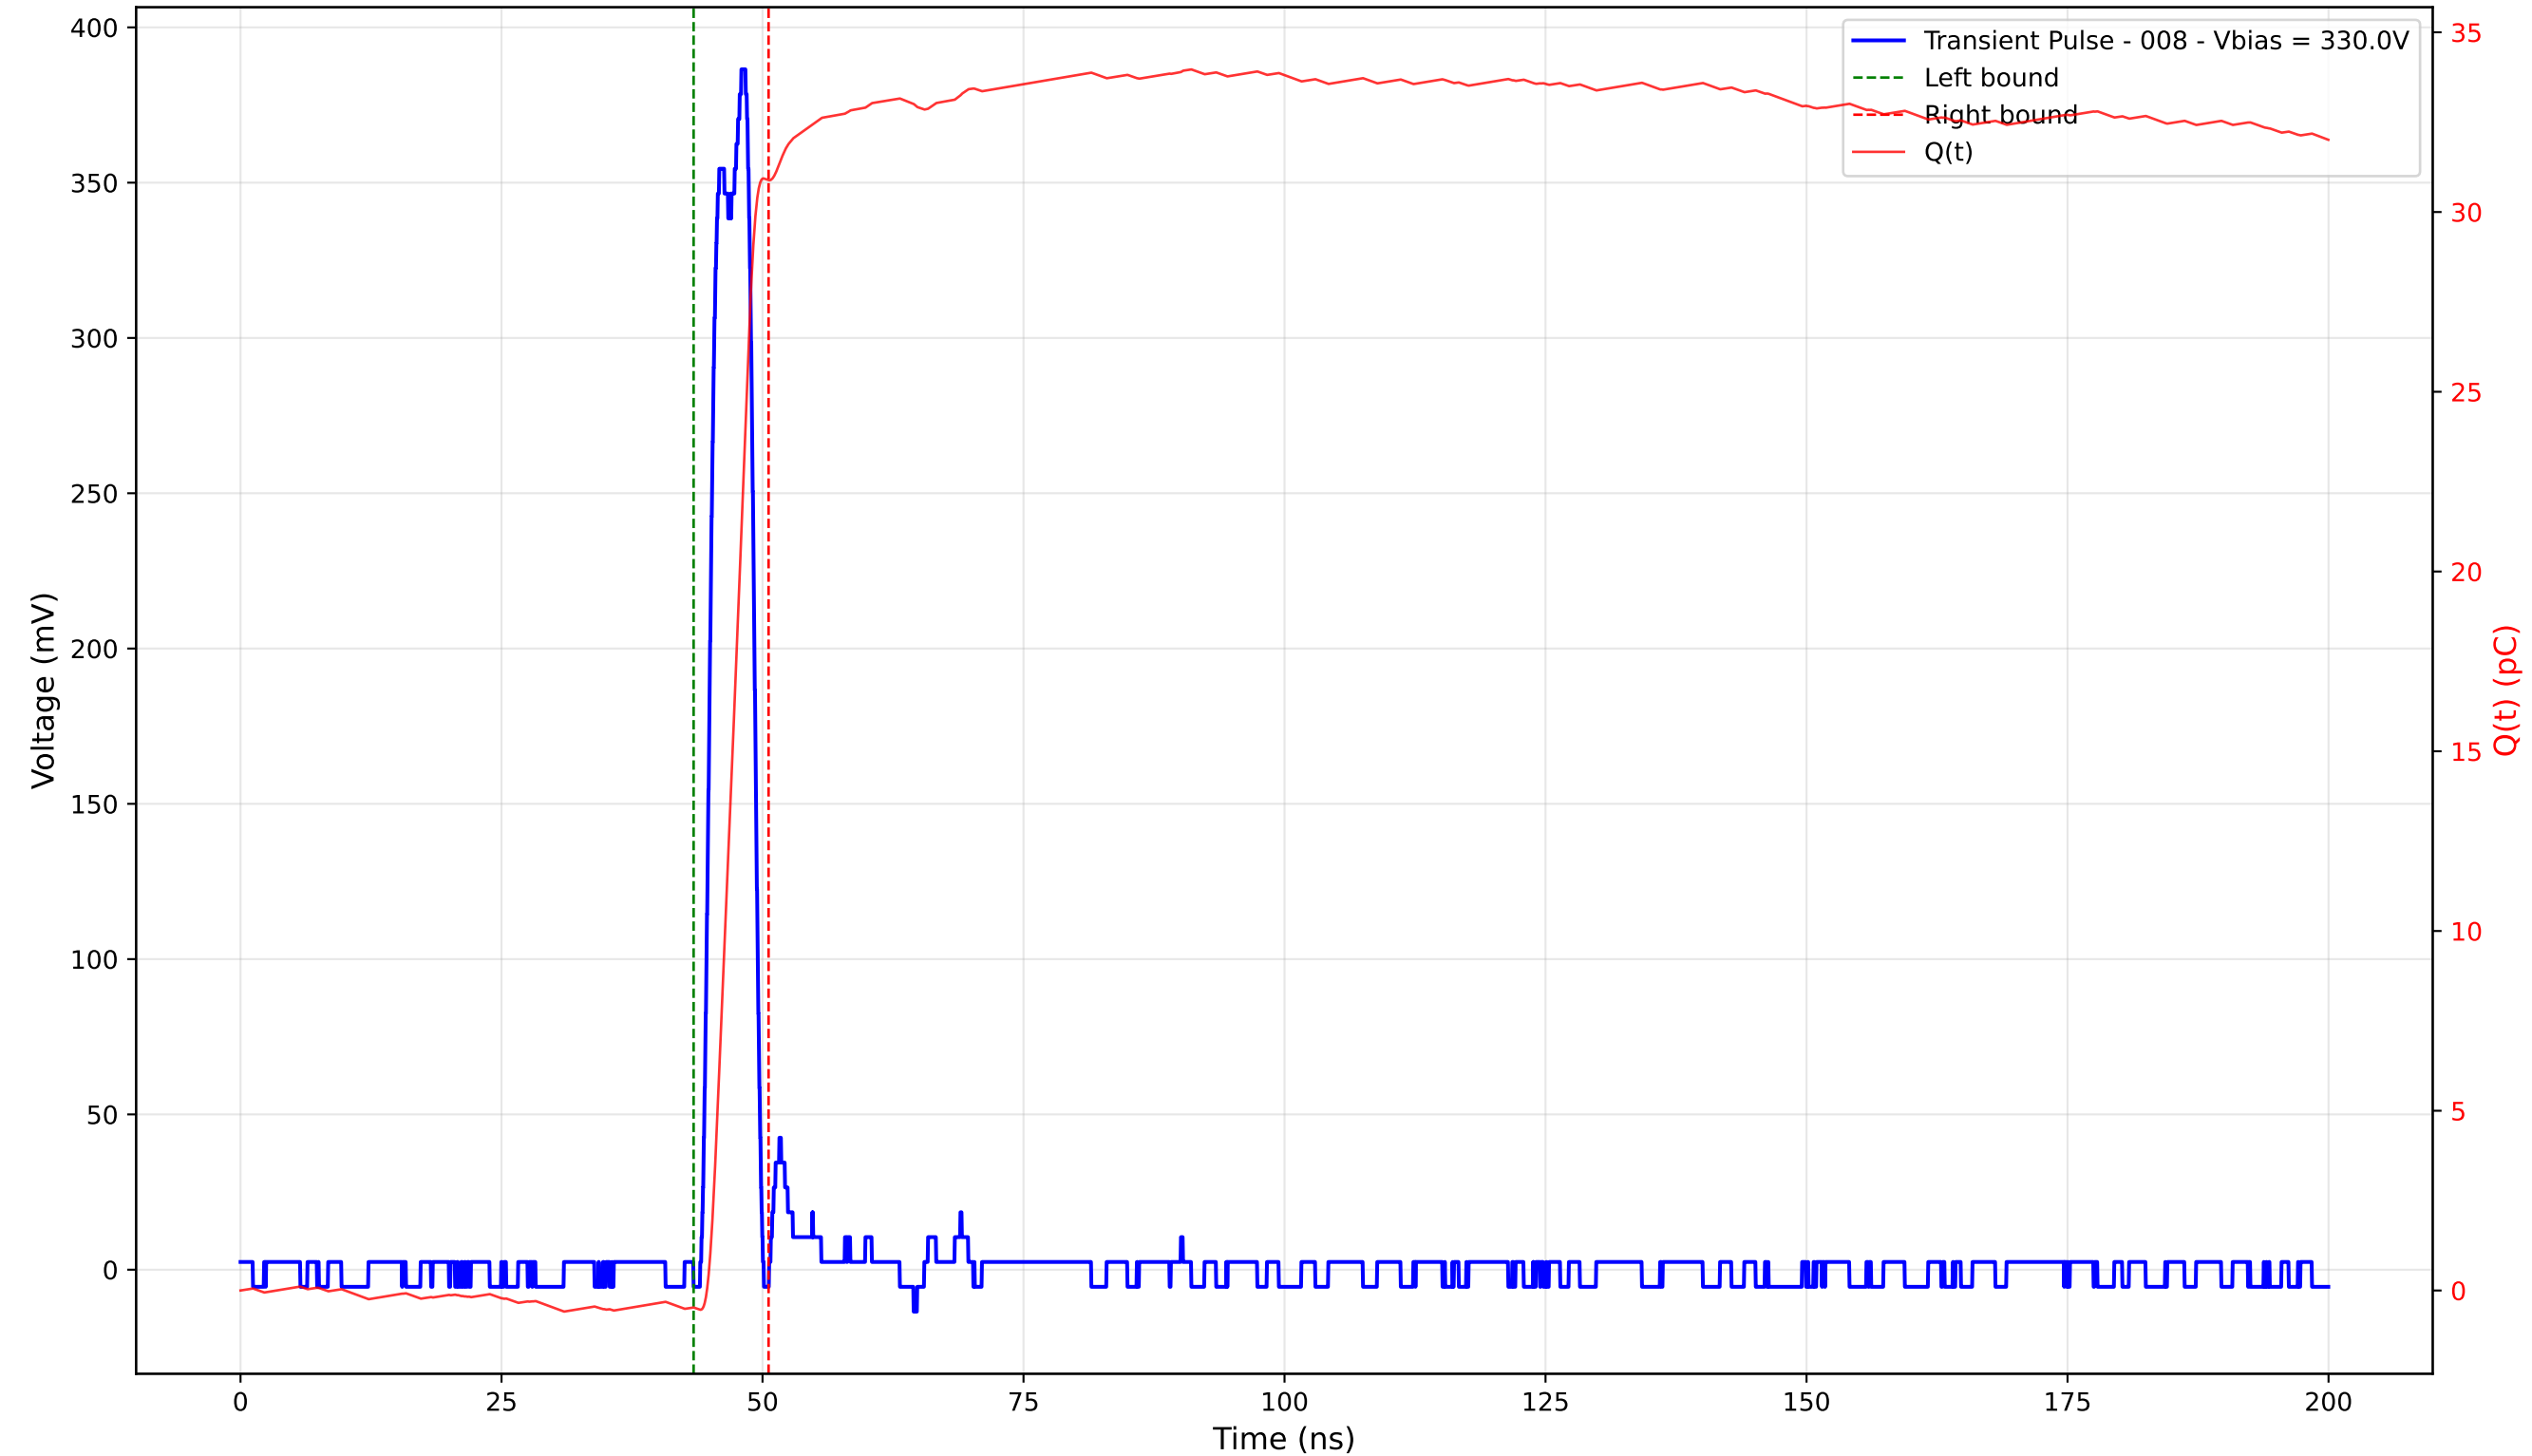


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 32.66 pC - Rise Time: 3.04 ns

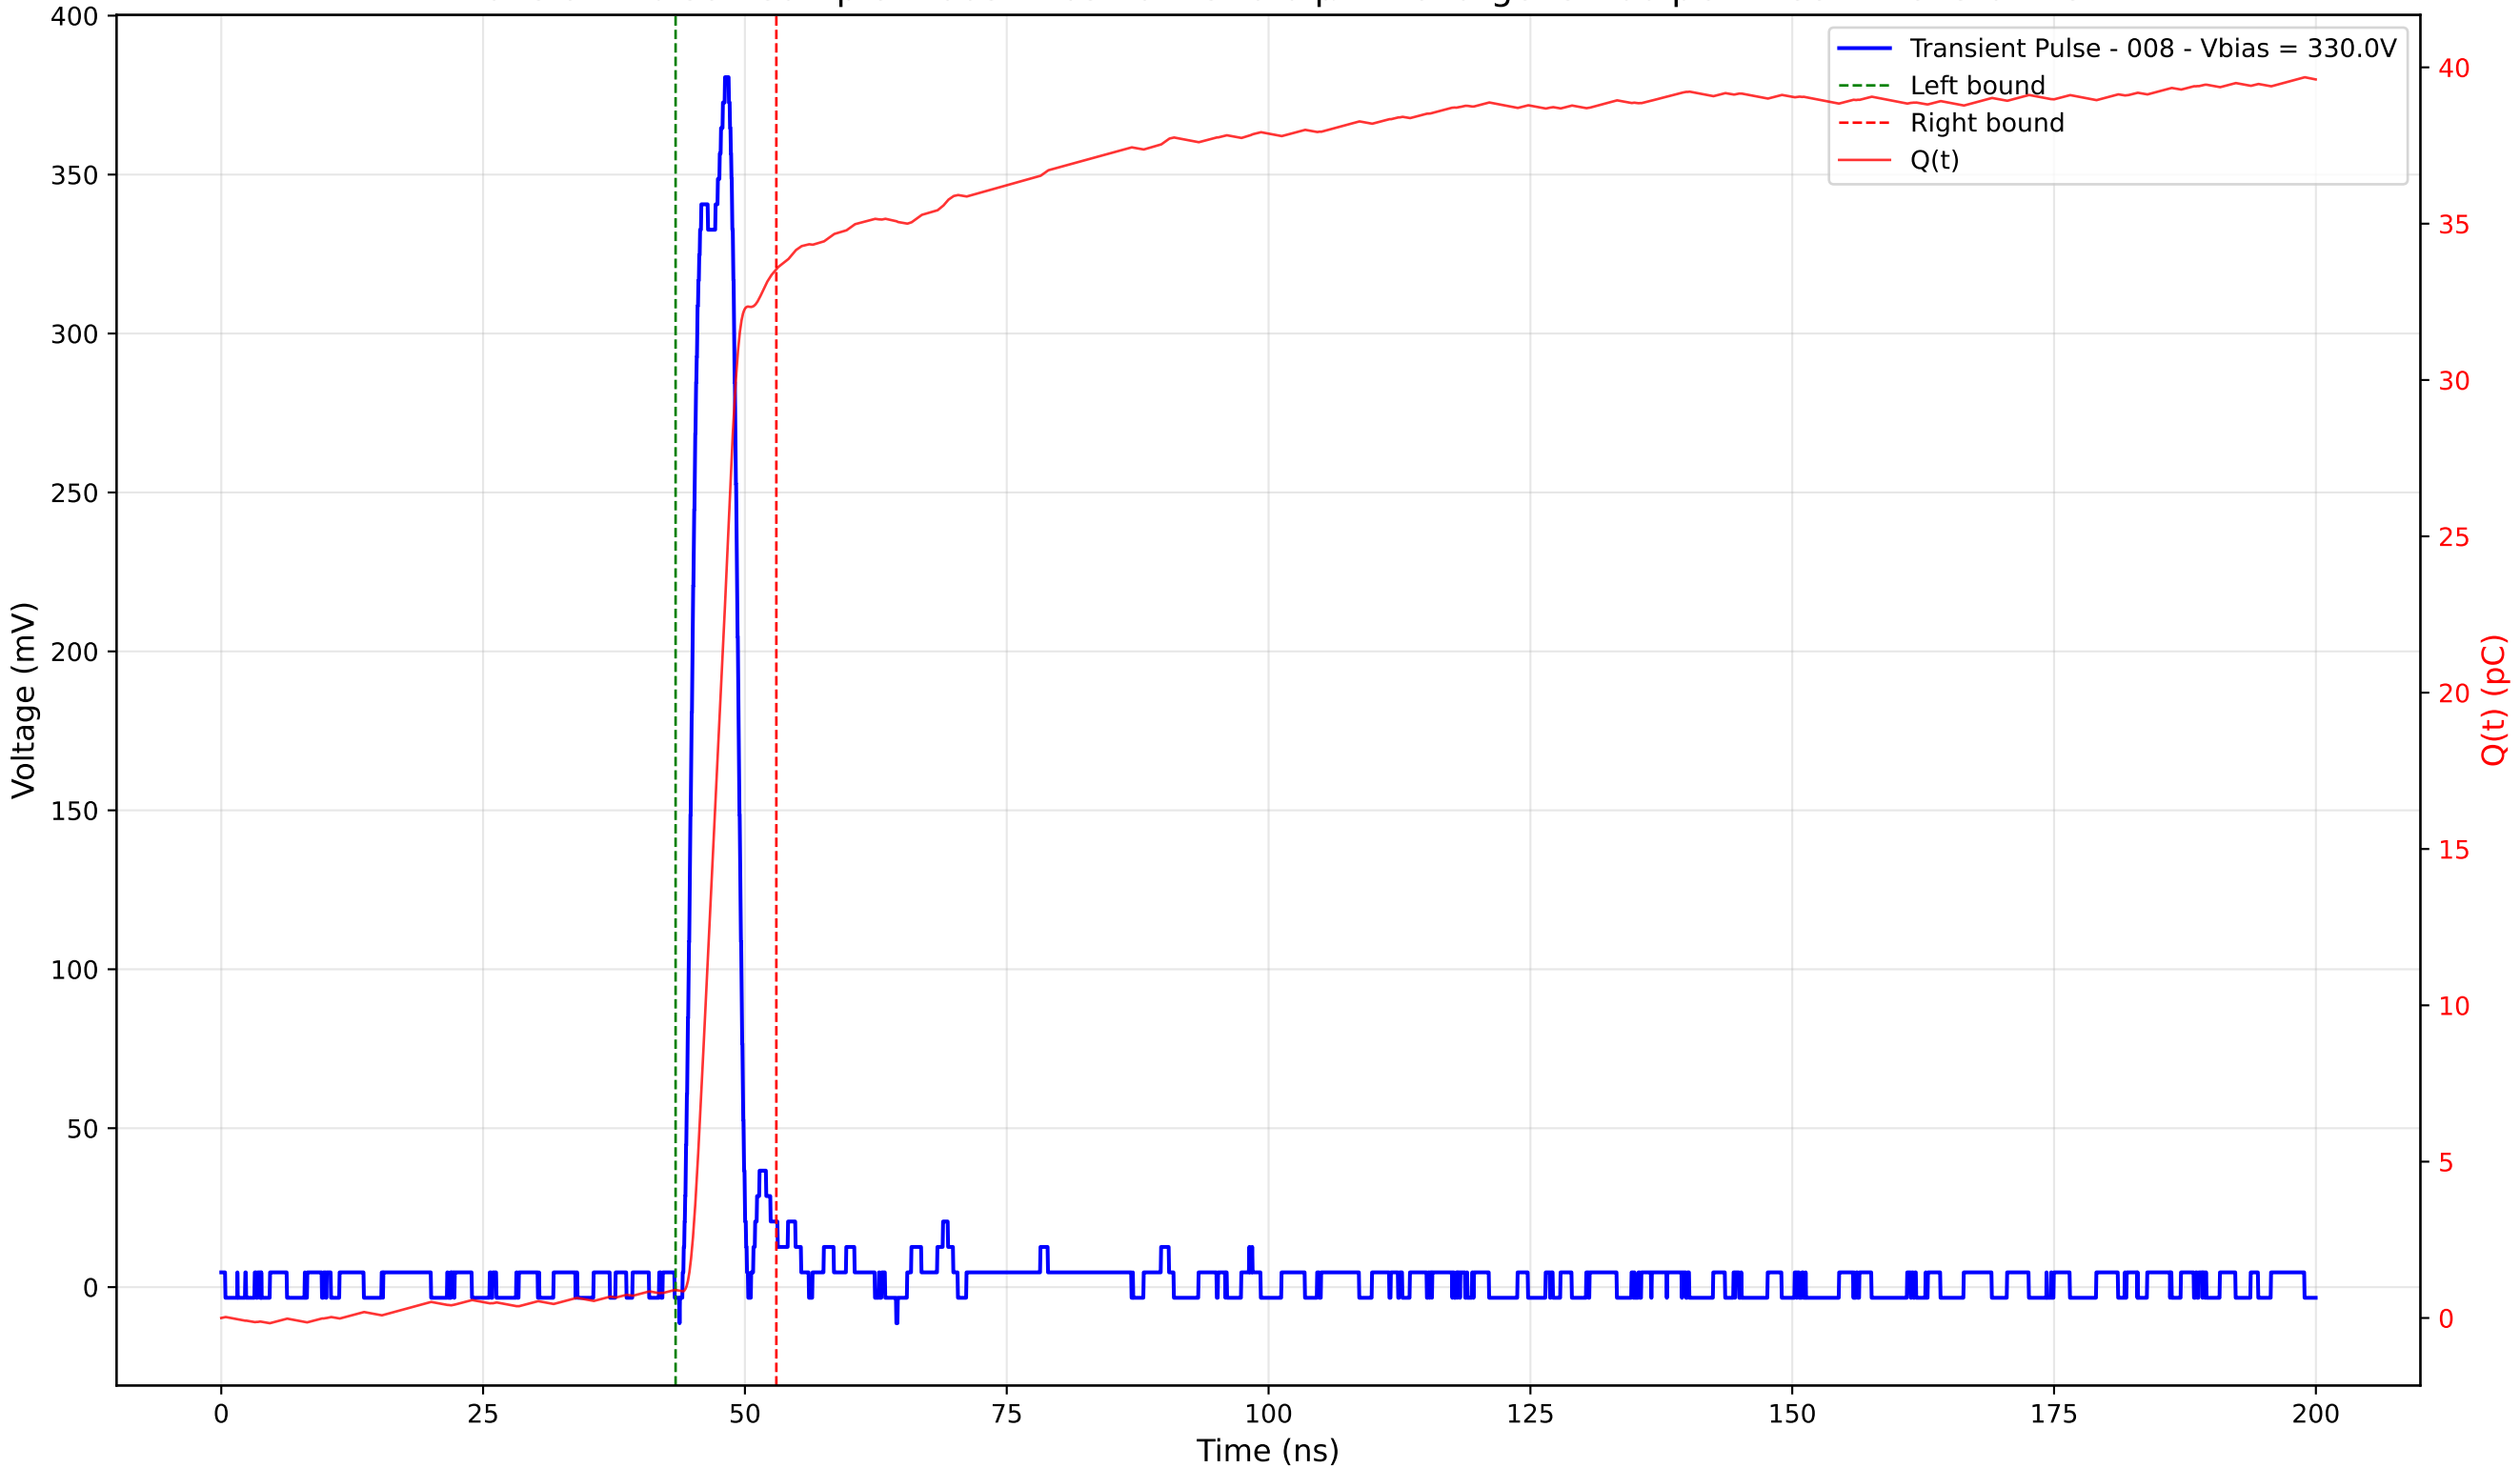


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 31.42 pC - Rise Time: 3.17 ns

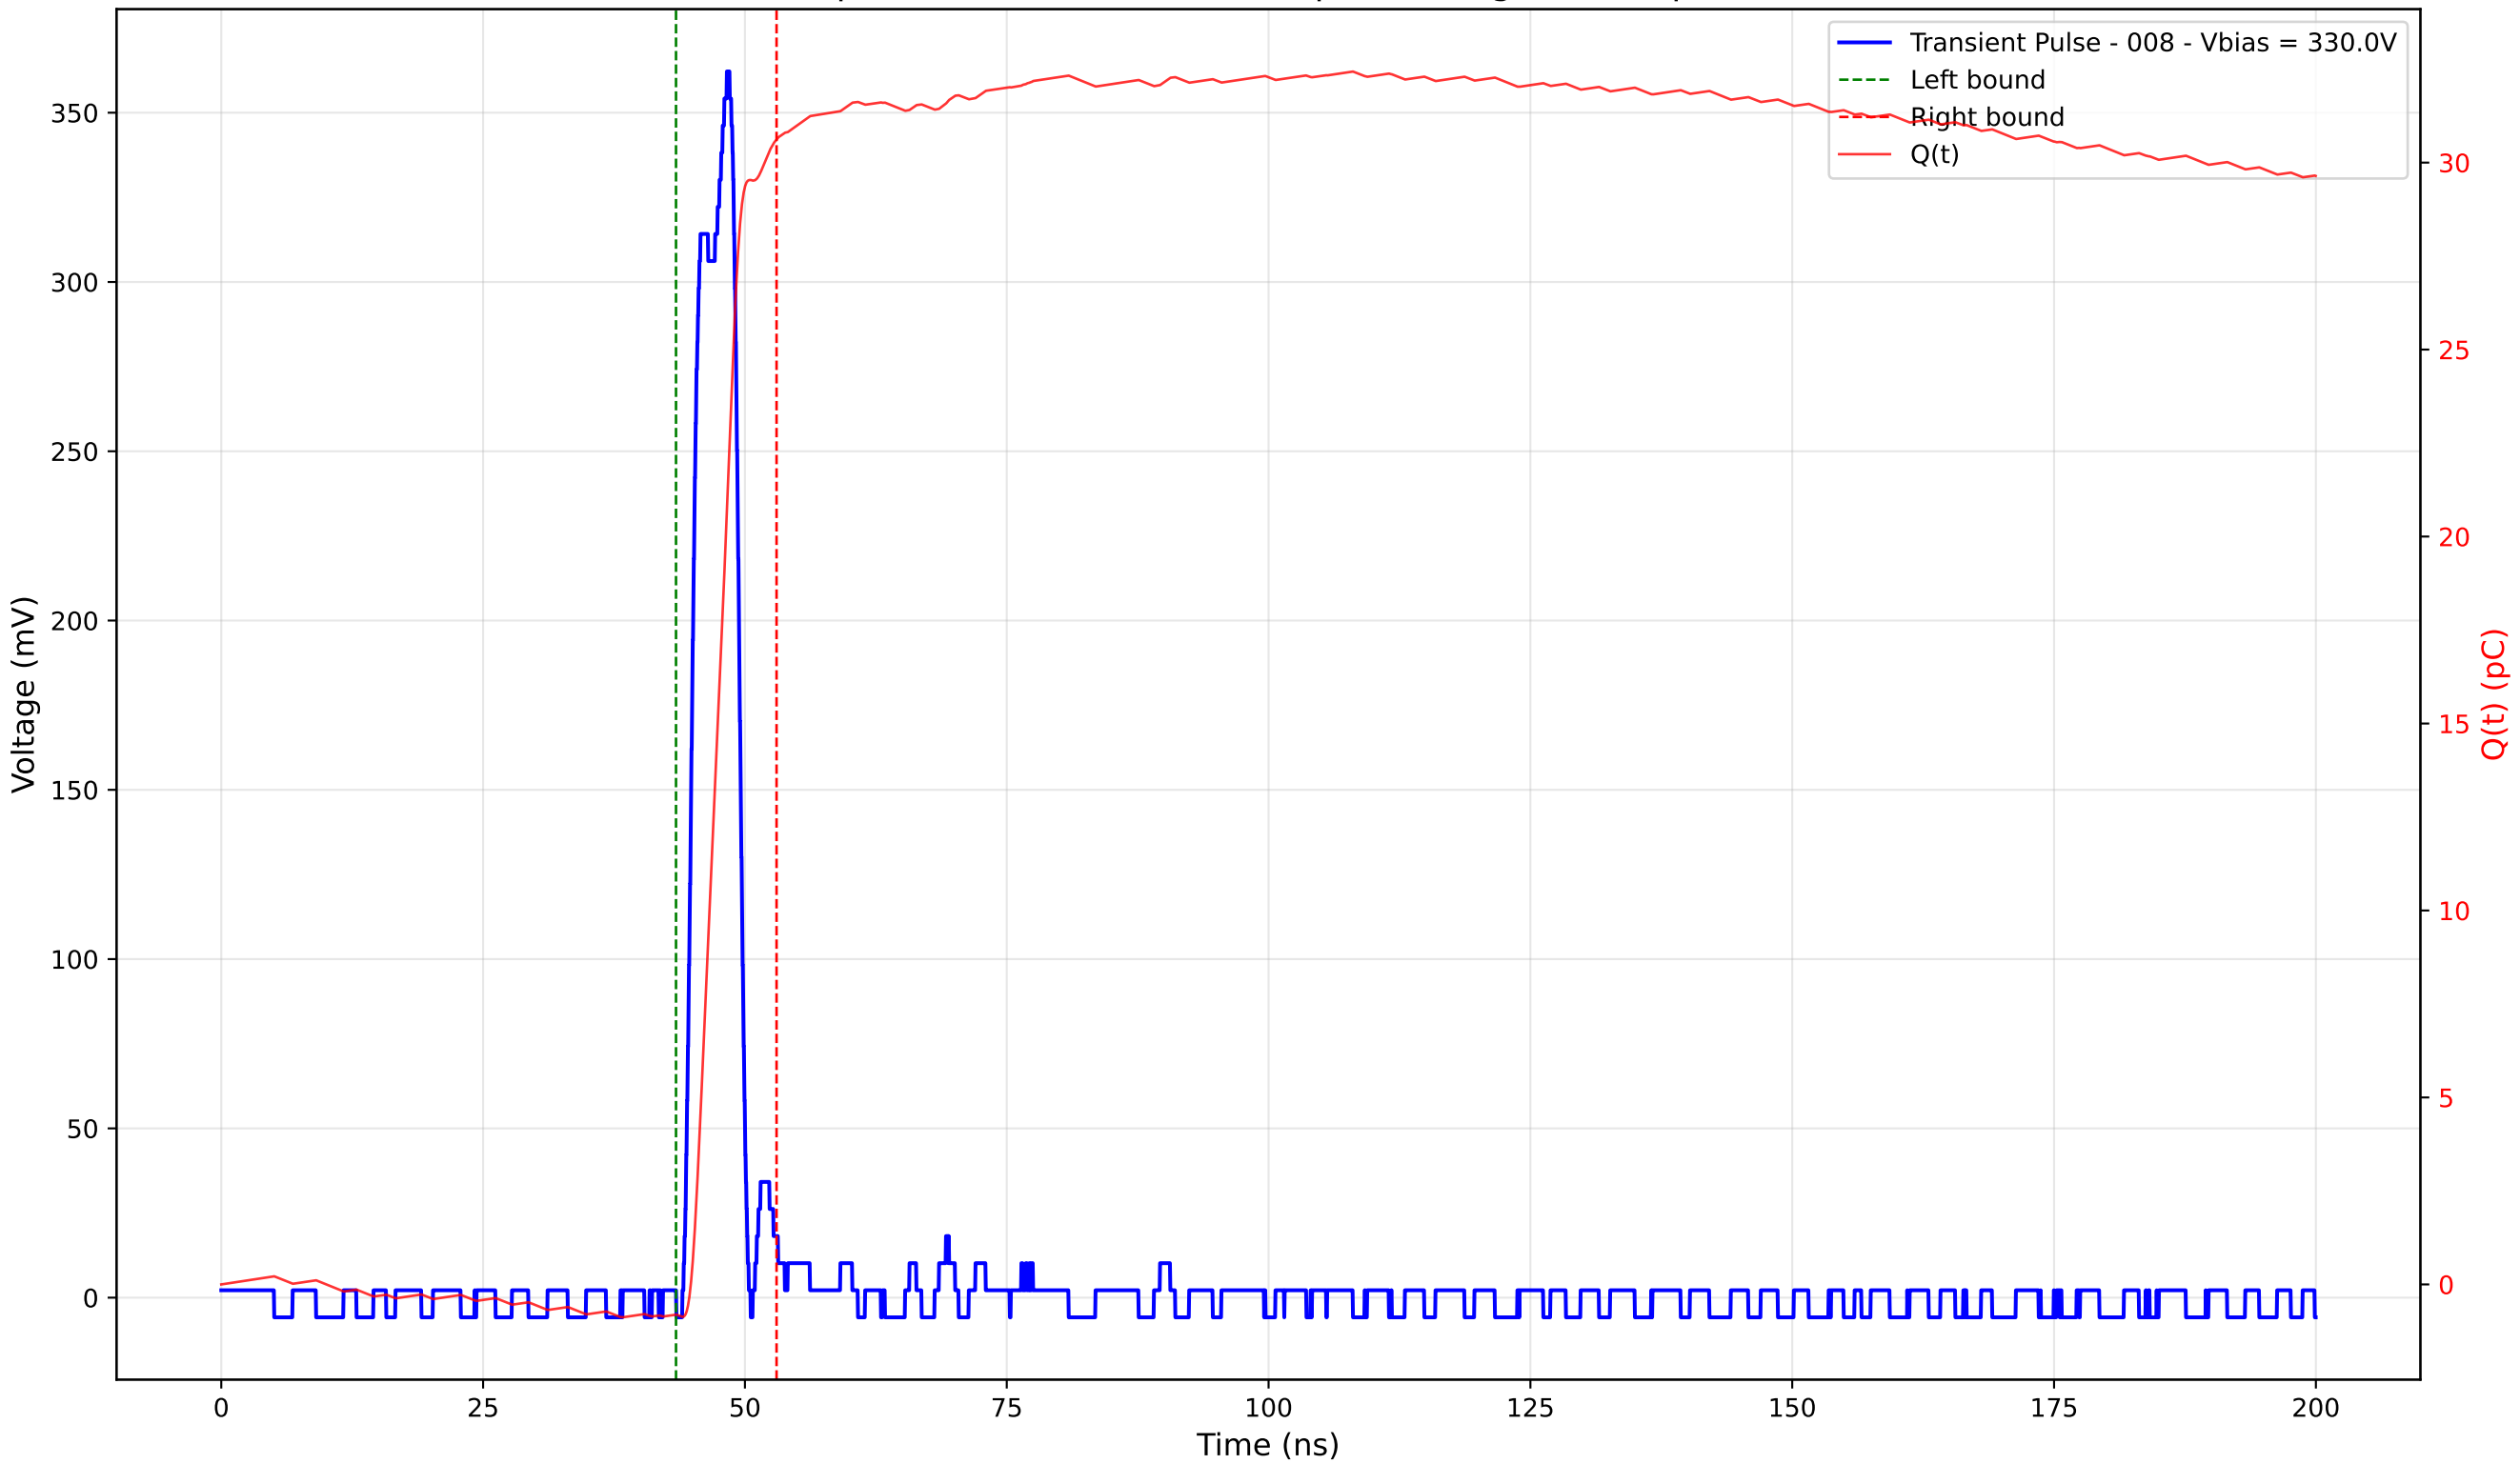


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 30.59 pC - Rise Time: 1.56 ns

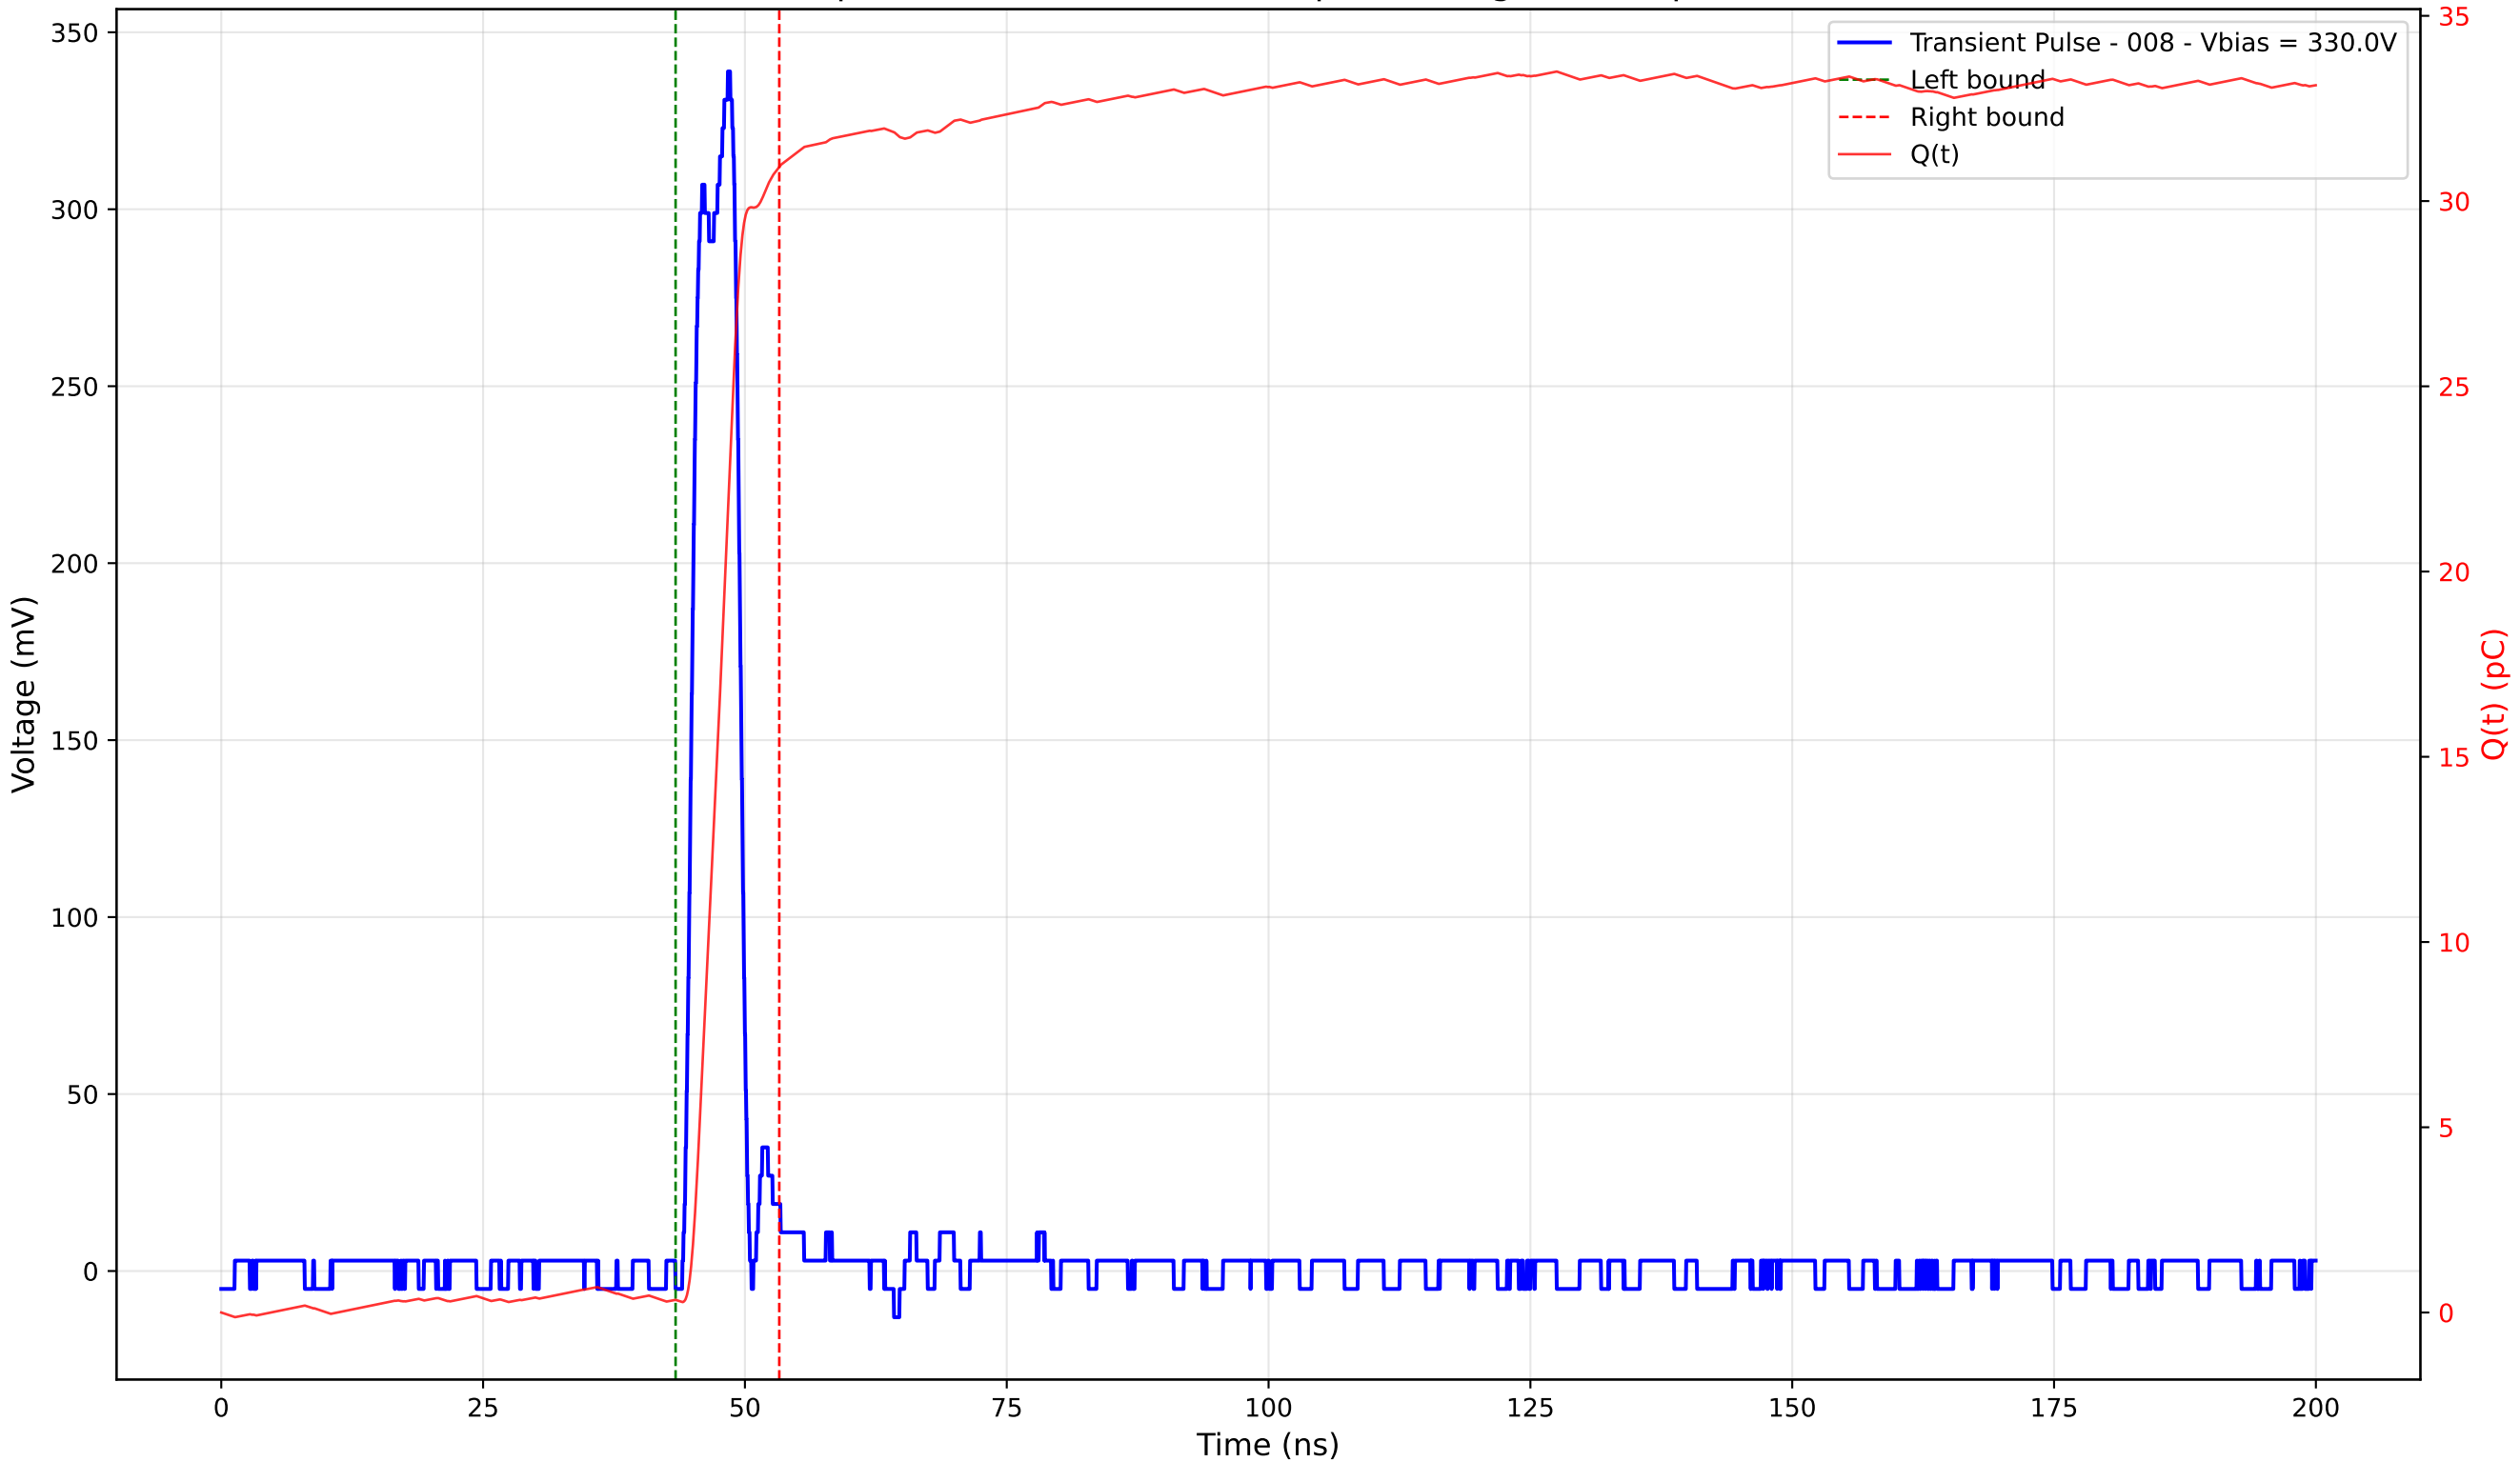


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 27.64 pC - Rise Time: 3.16 ns

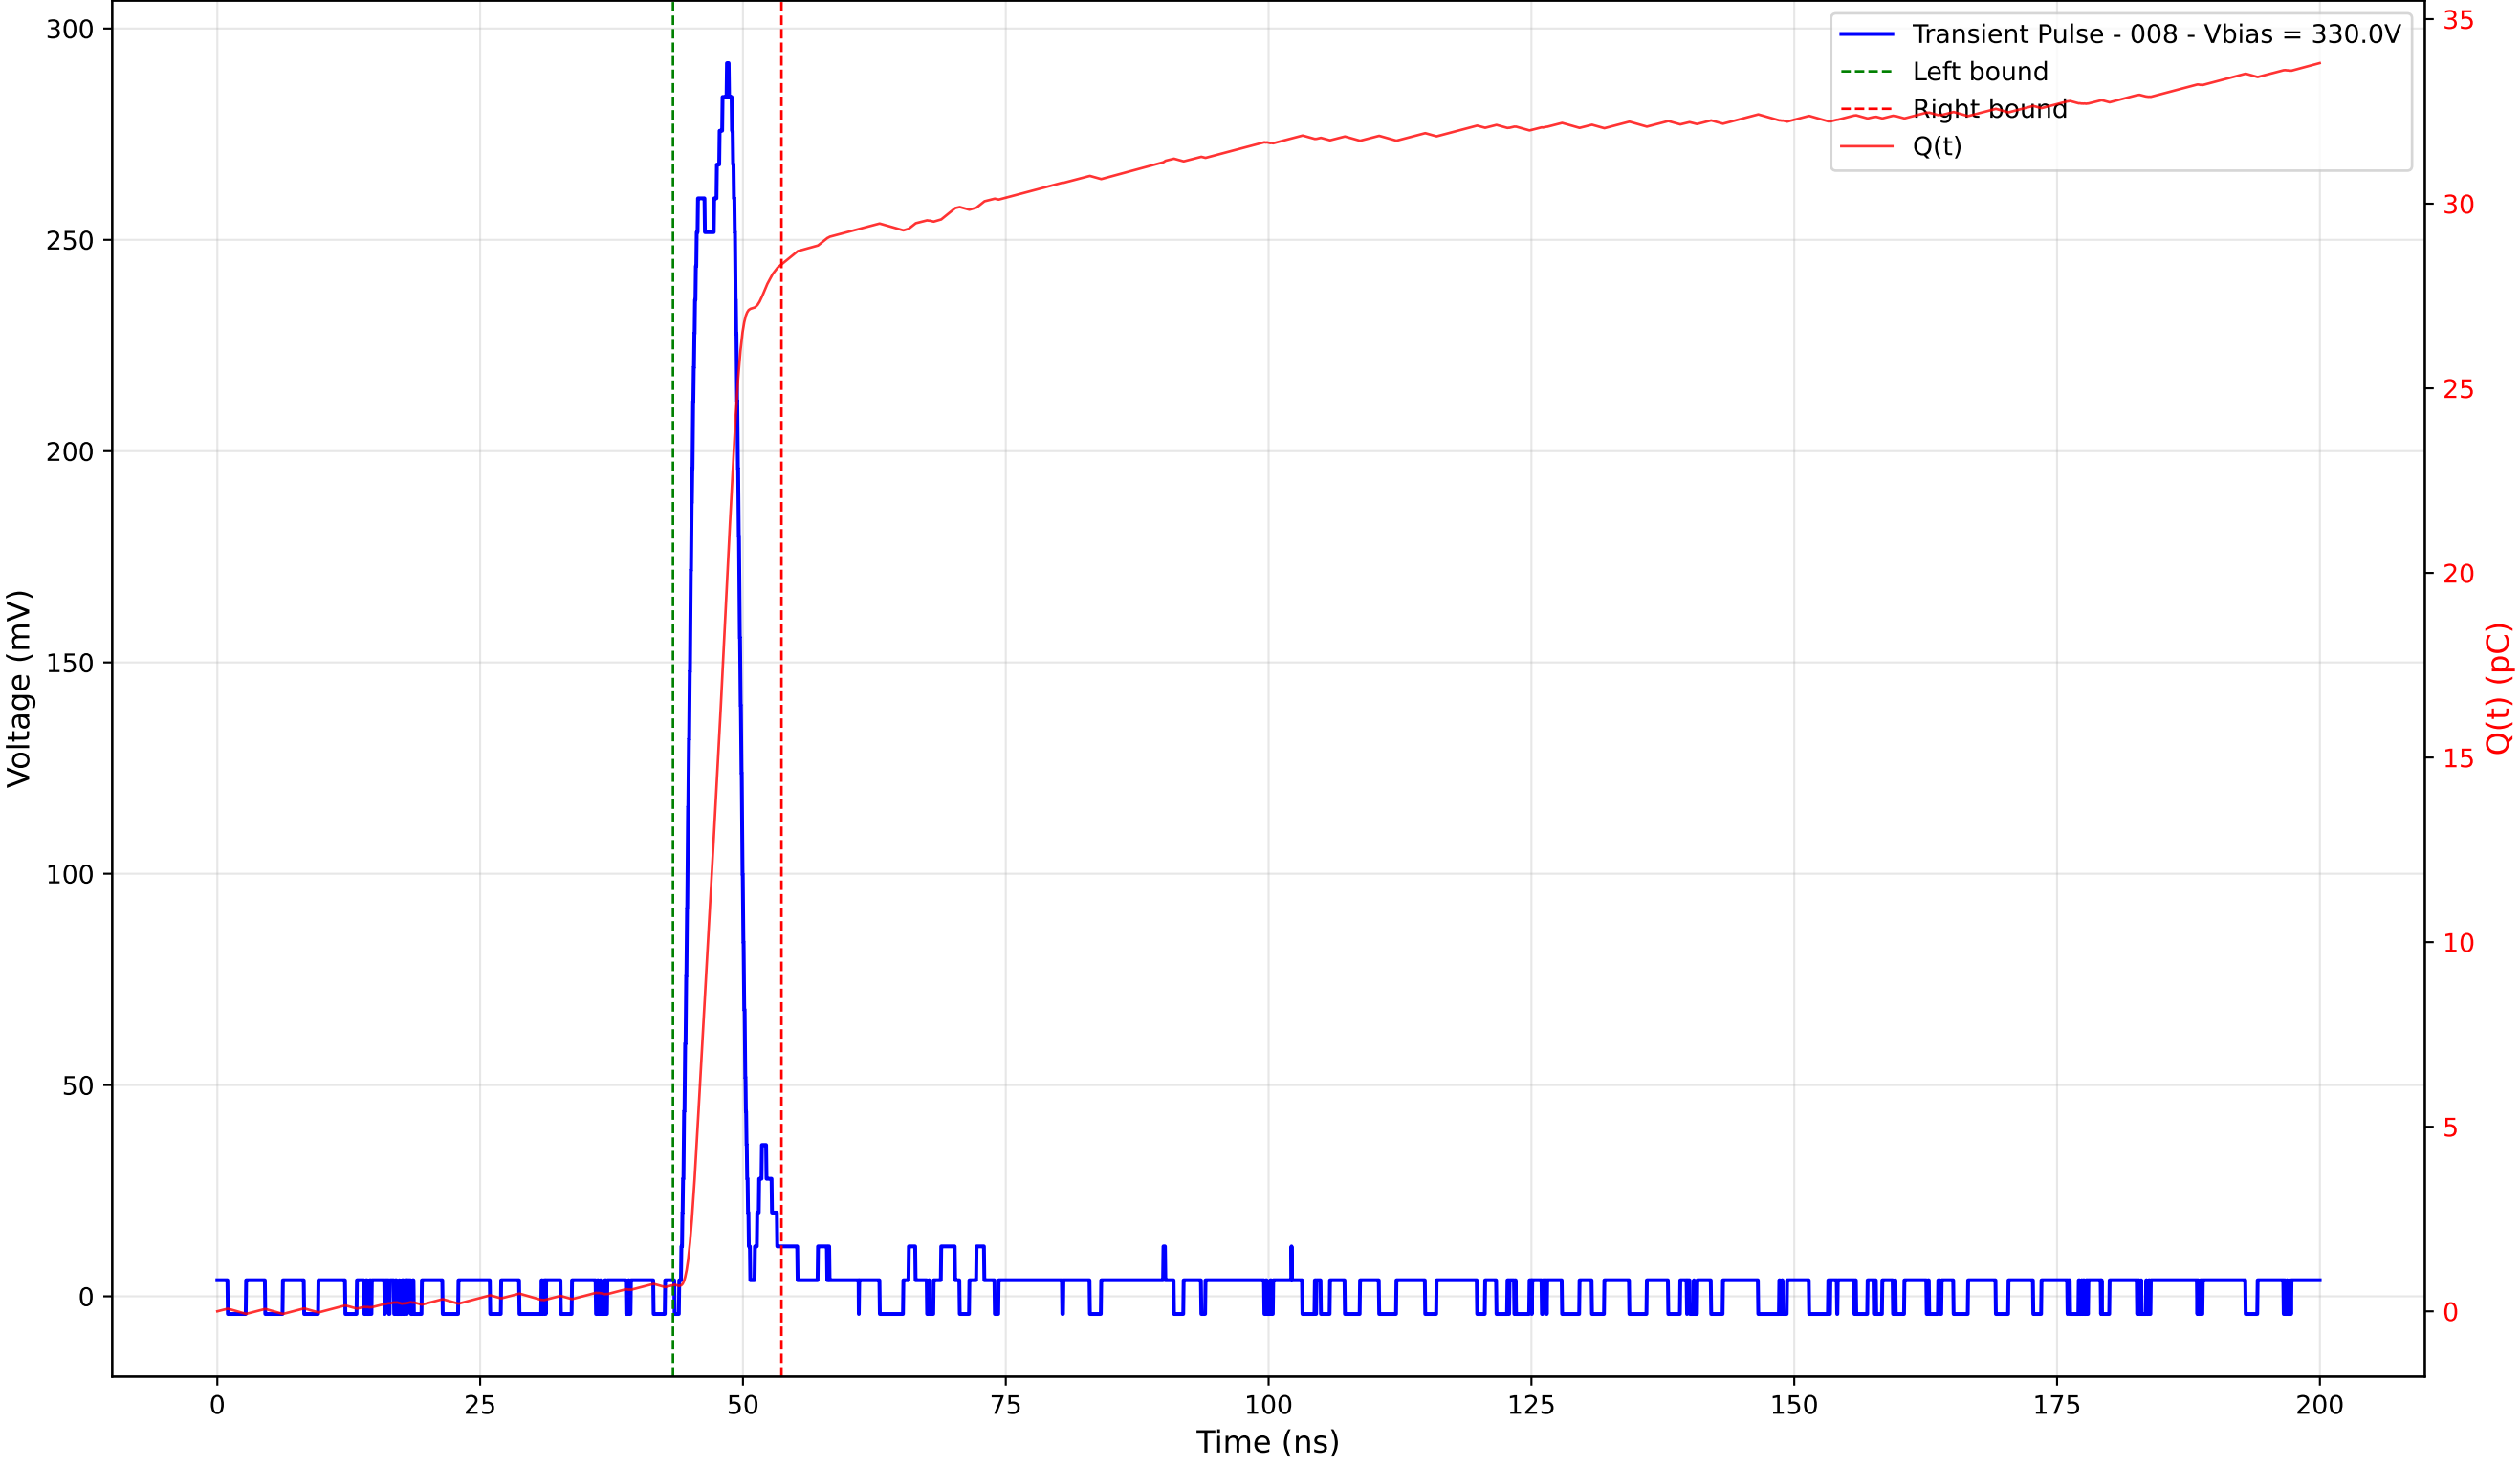


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 22.34 pC - Rise Time: 1.31 ns

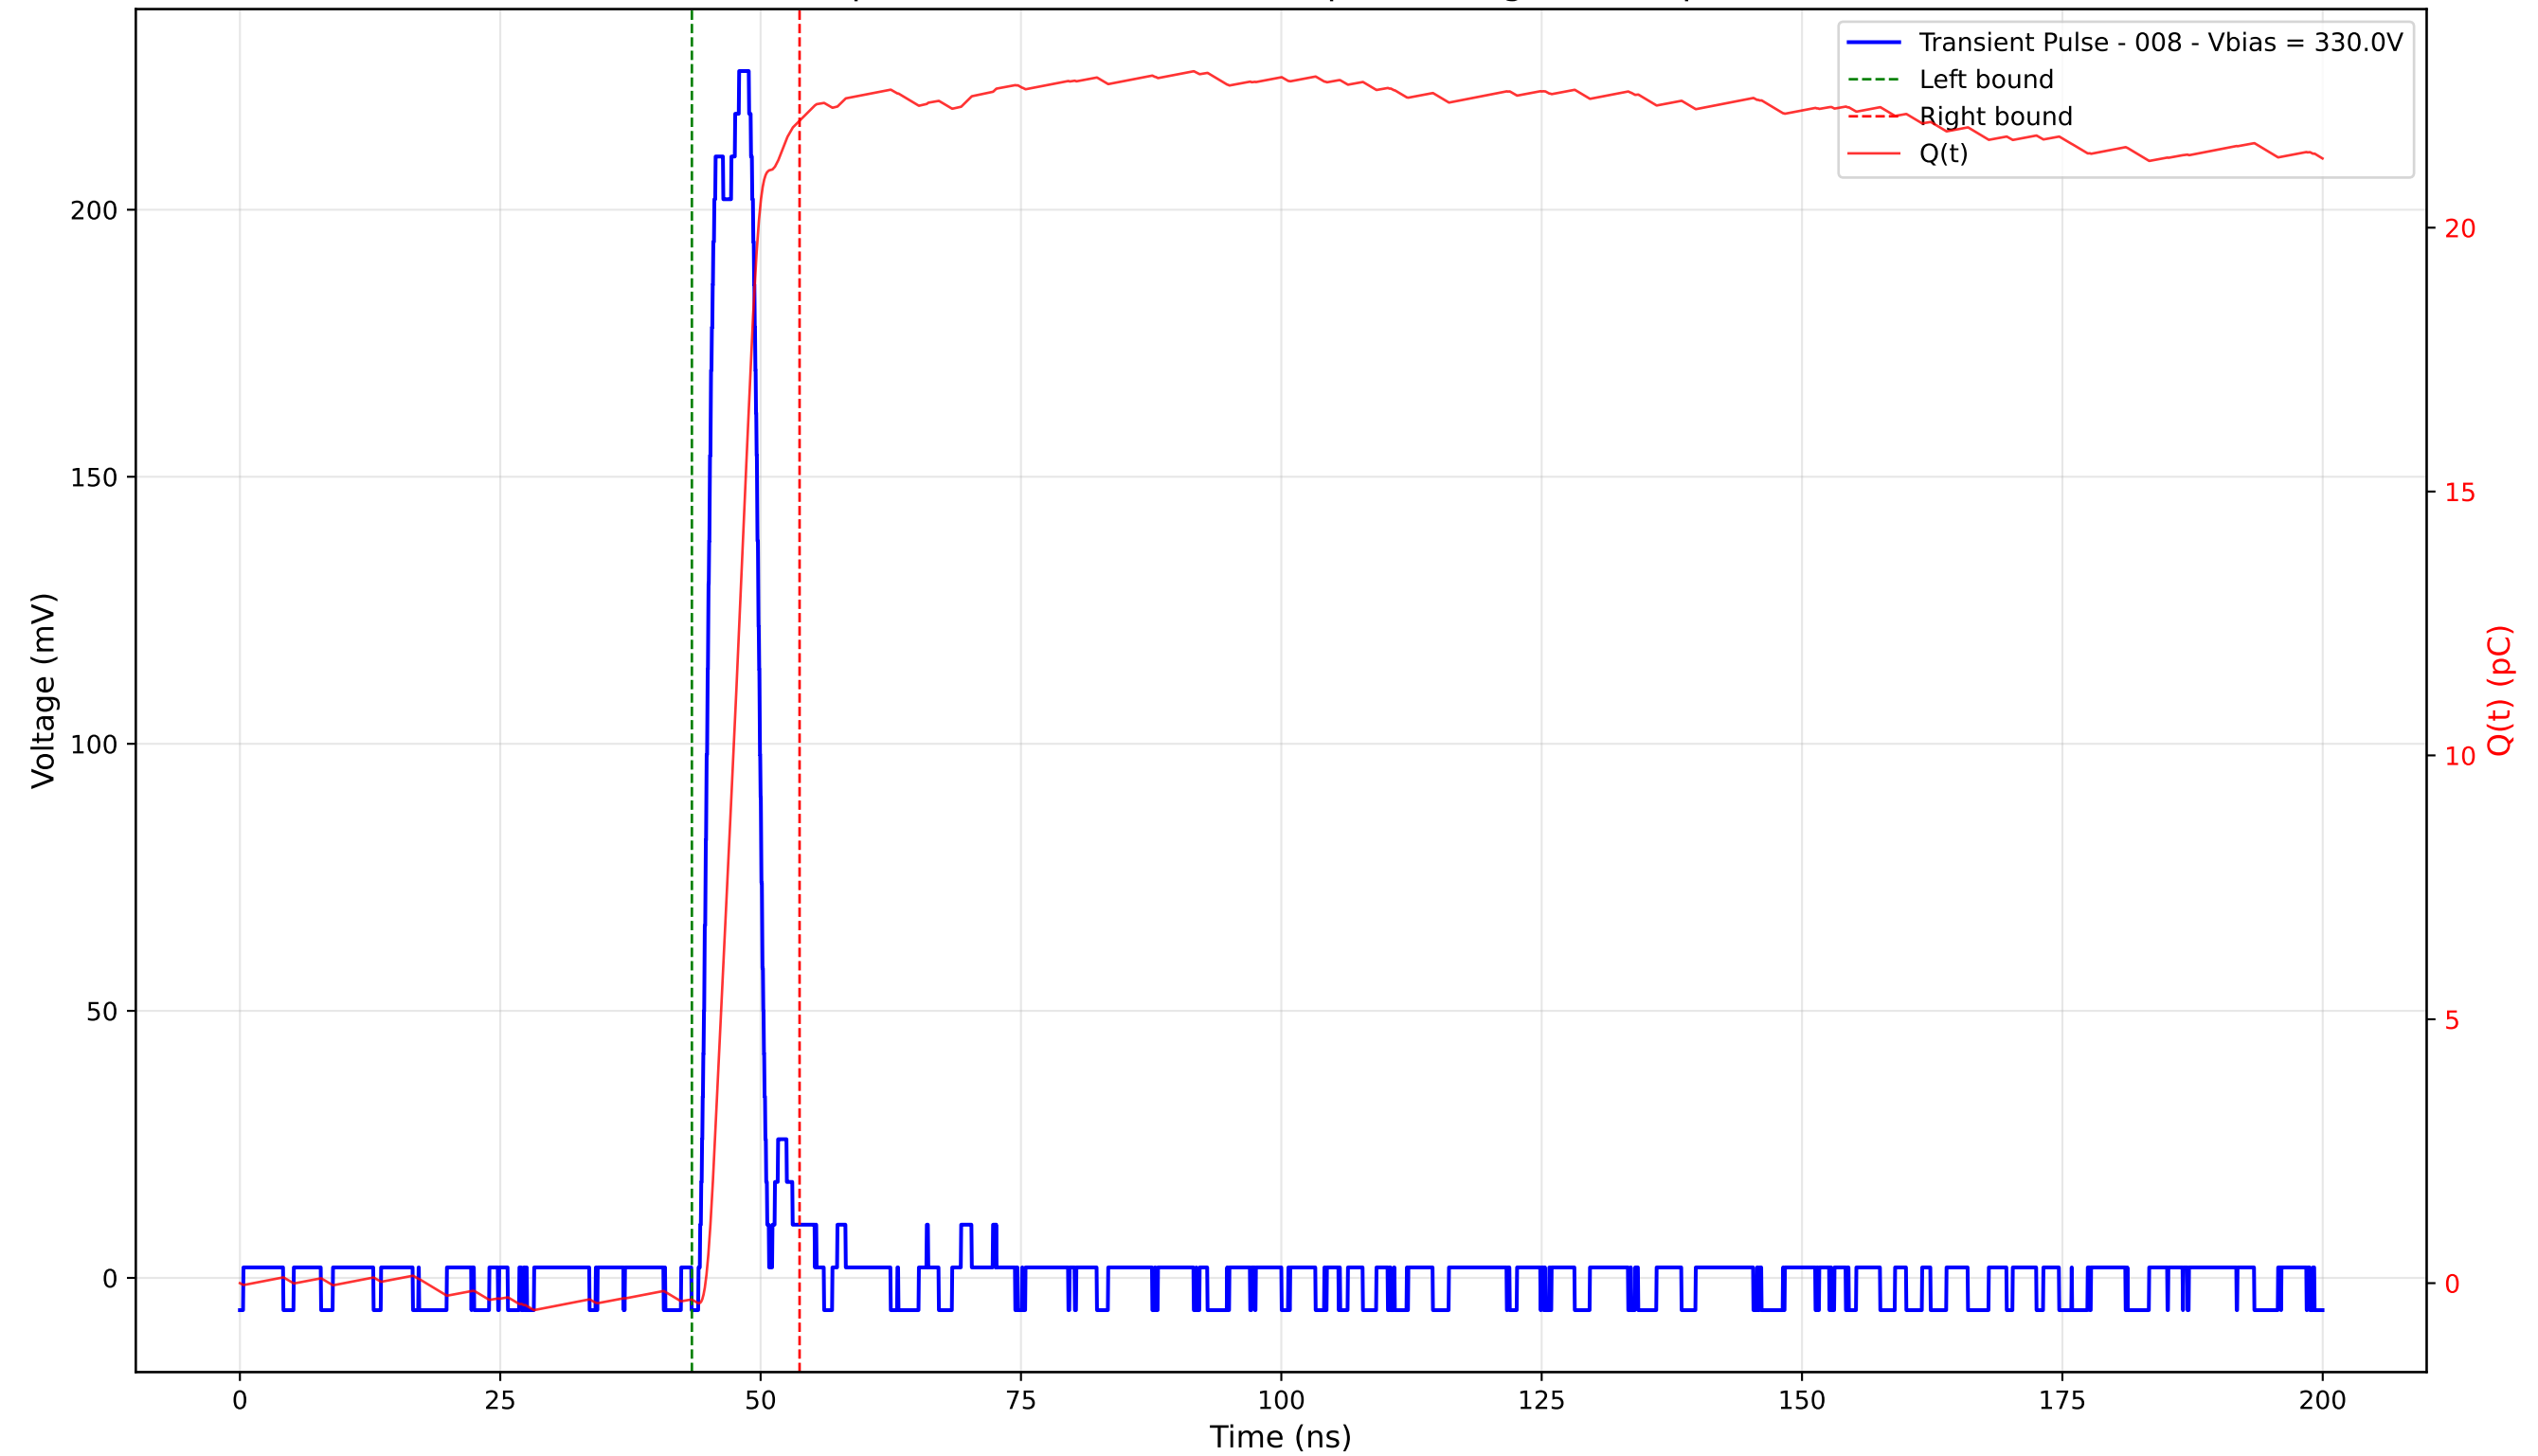


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 17.66 pC - Rise Time: 1.04 ns

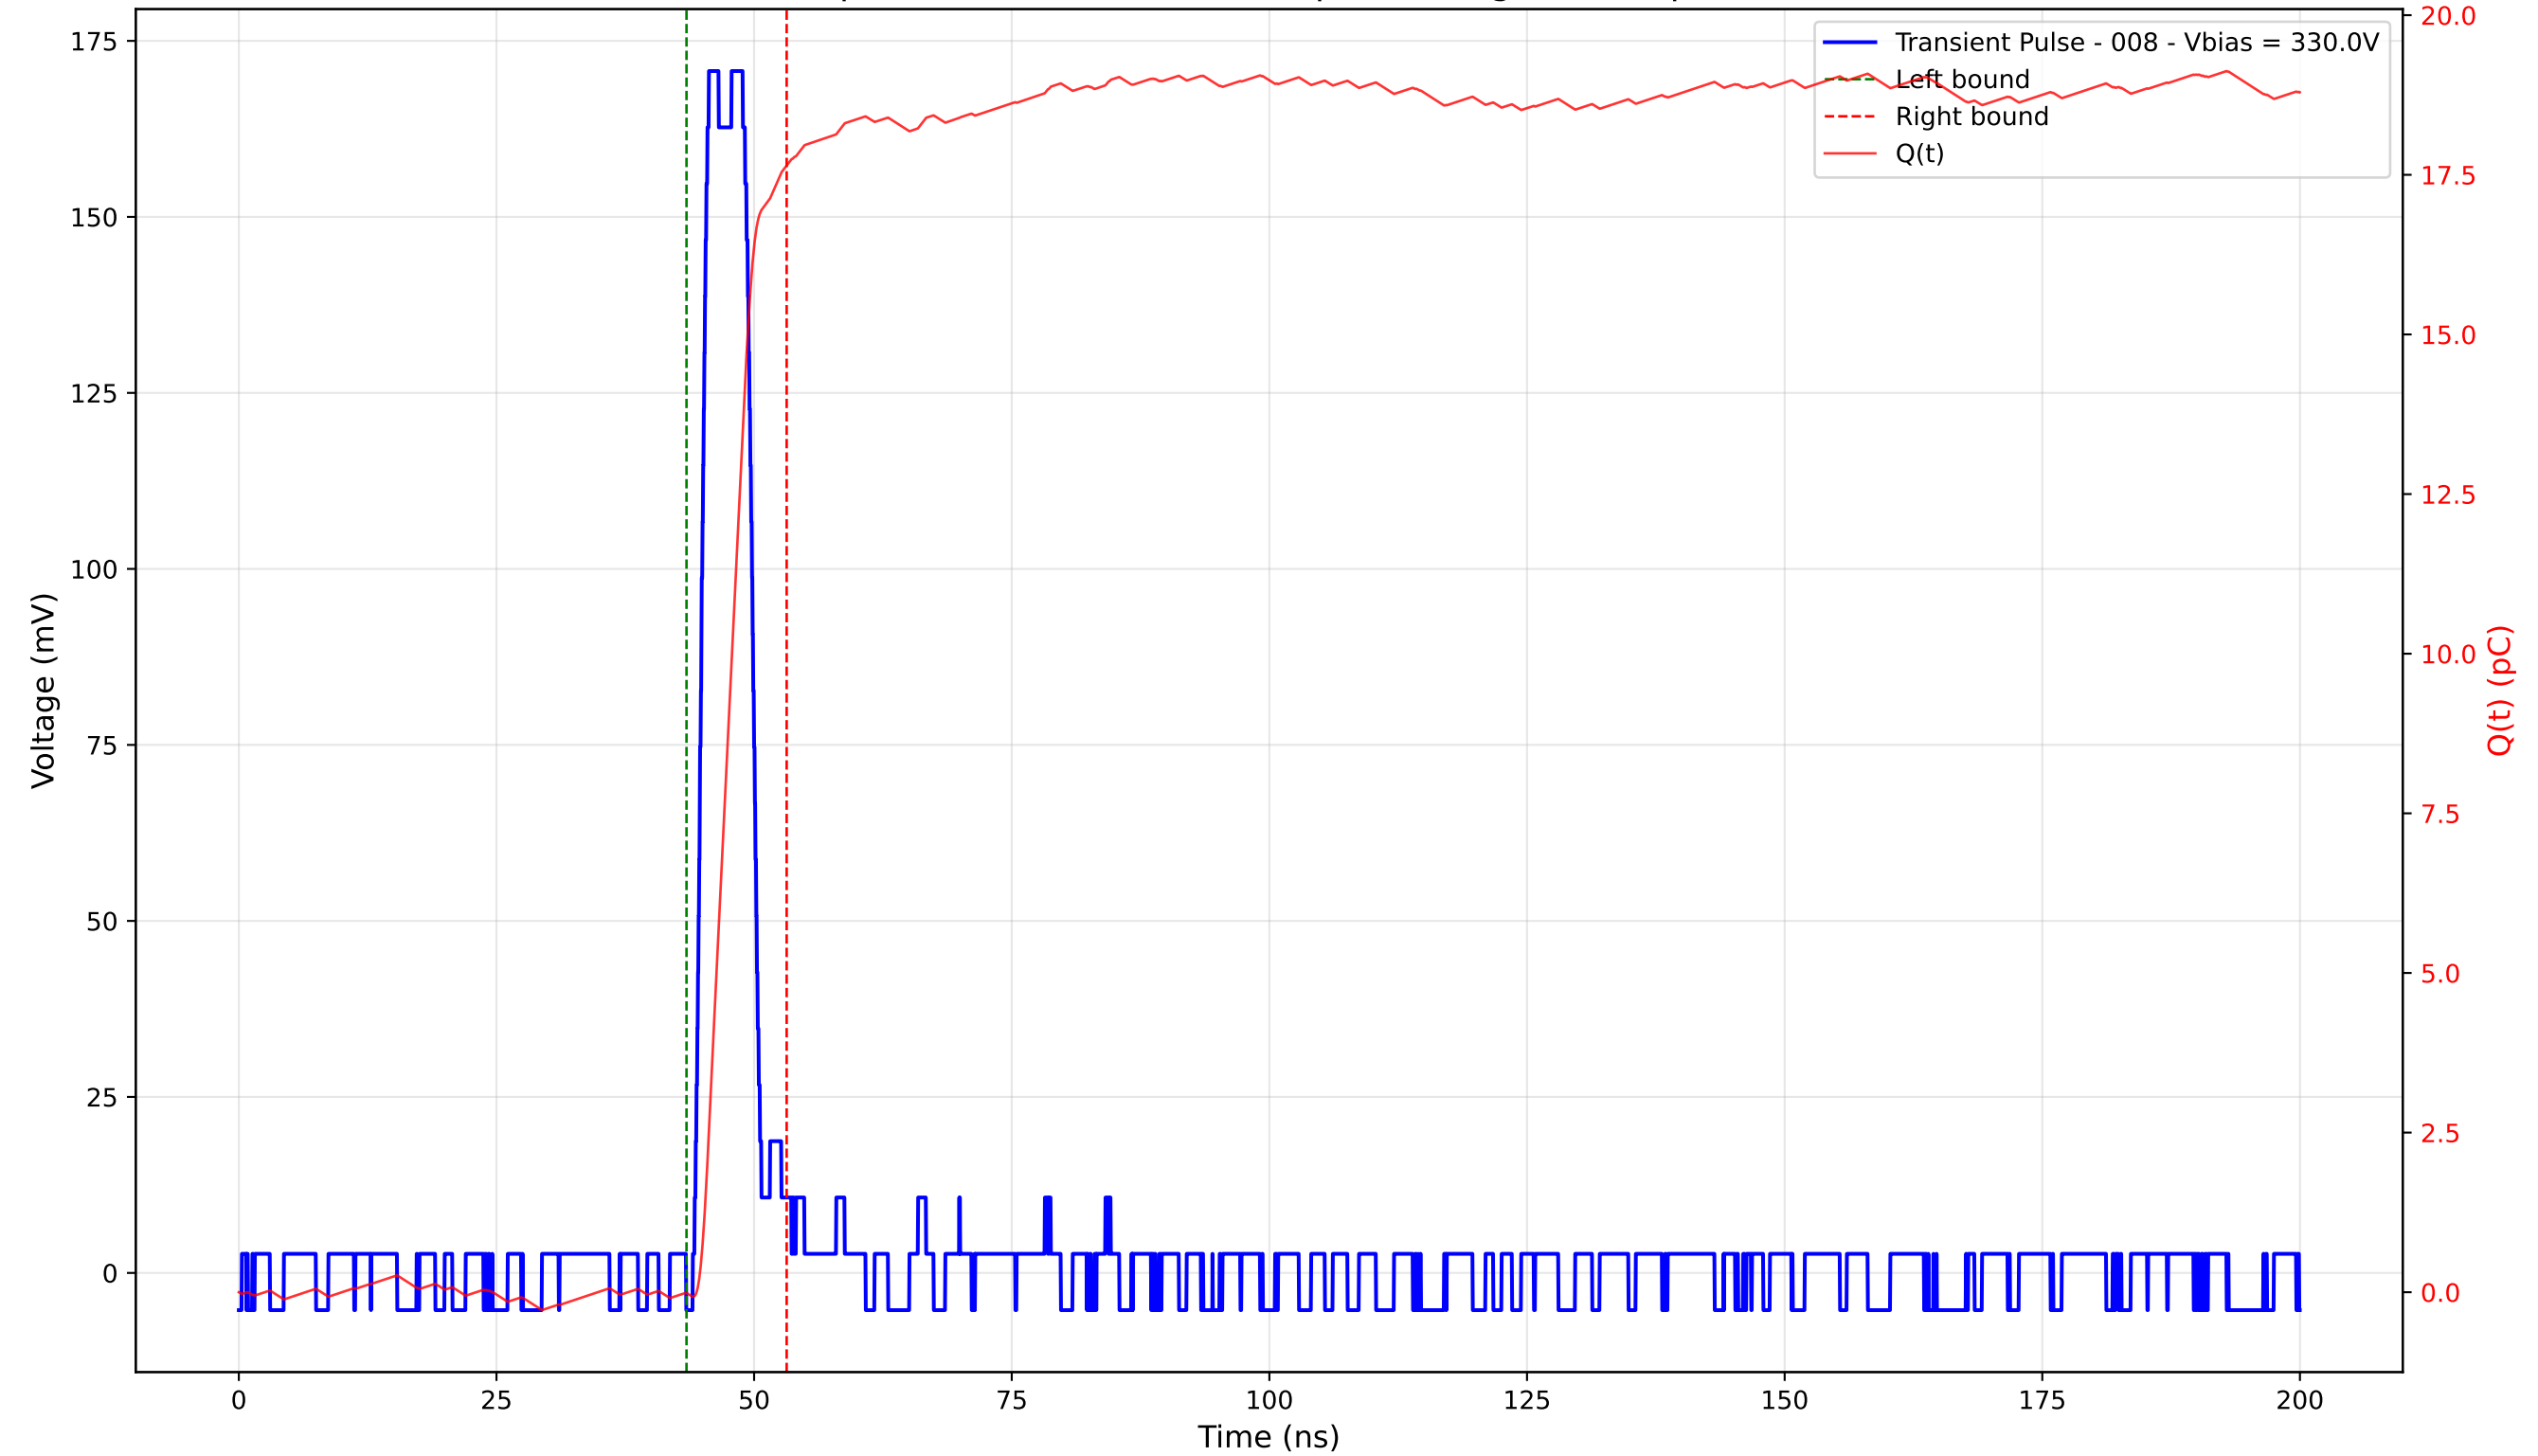


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 12.33 pC - Rise Time: 1.17 ns

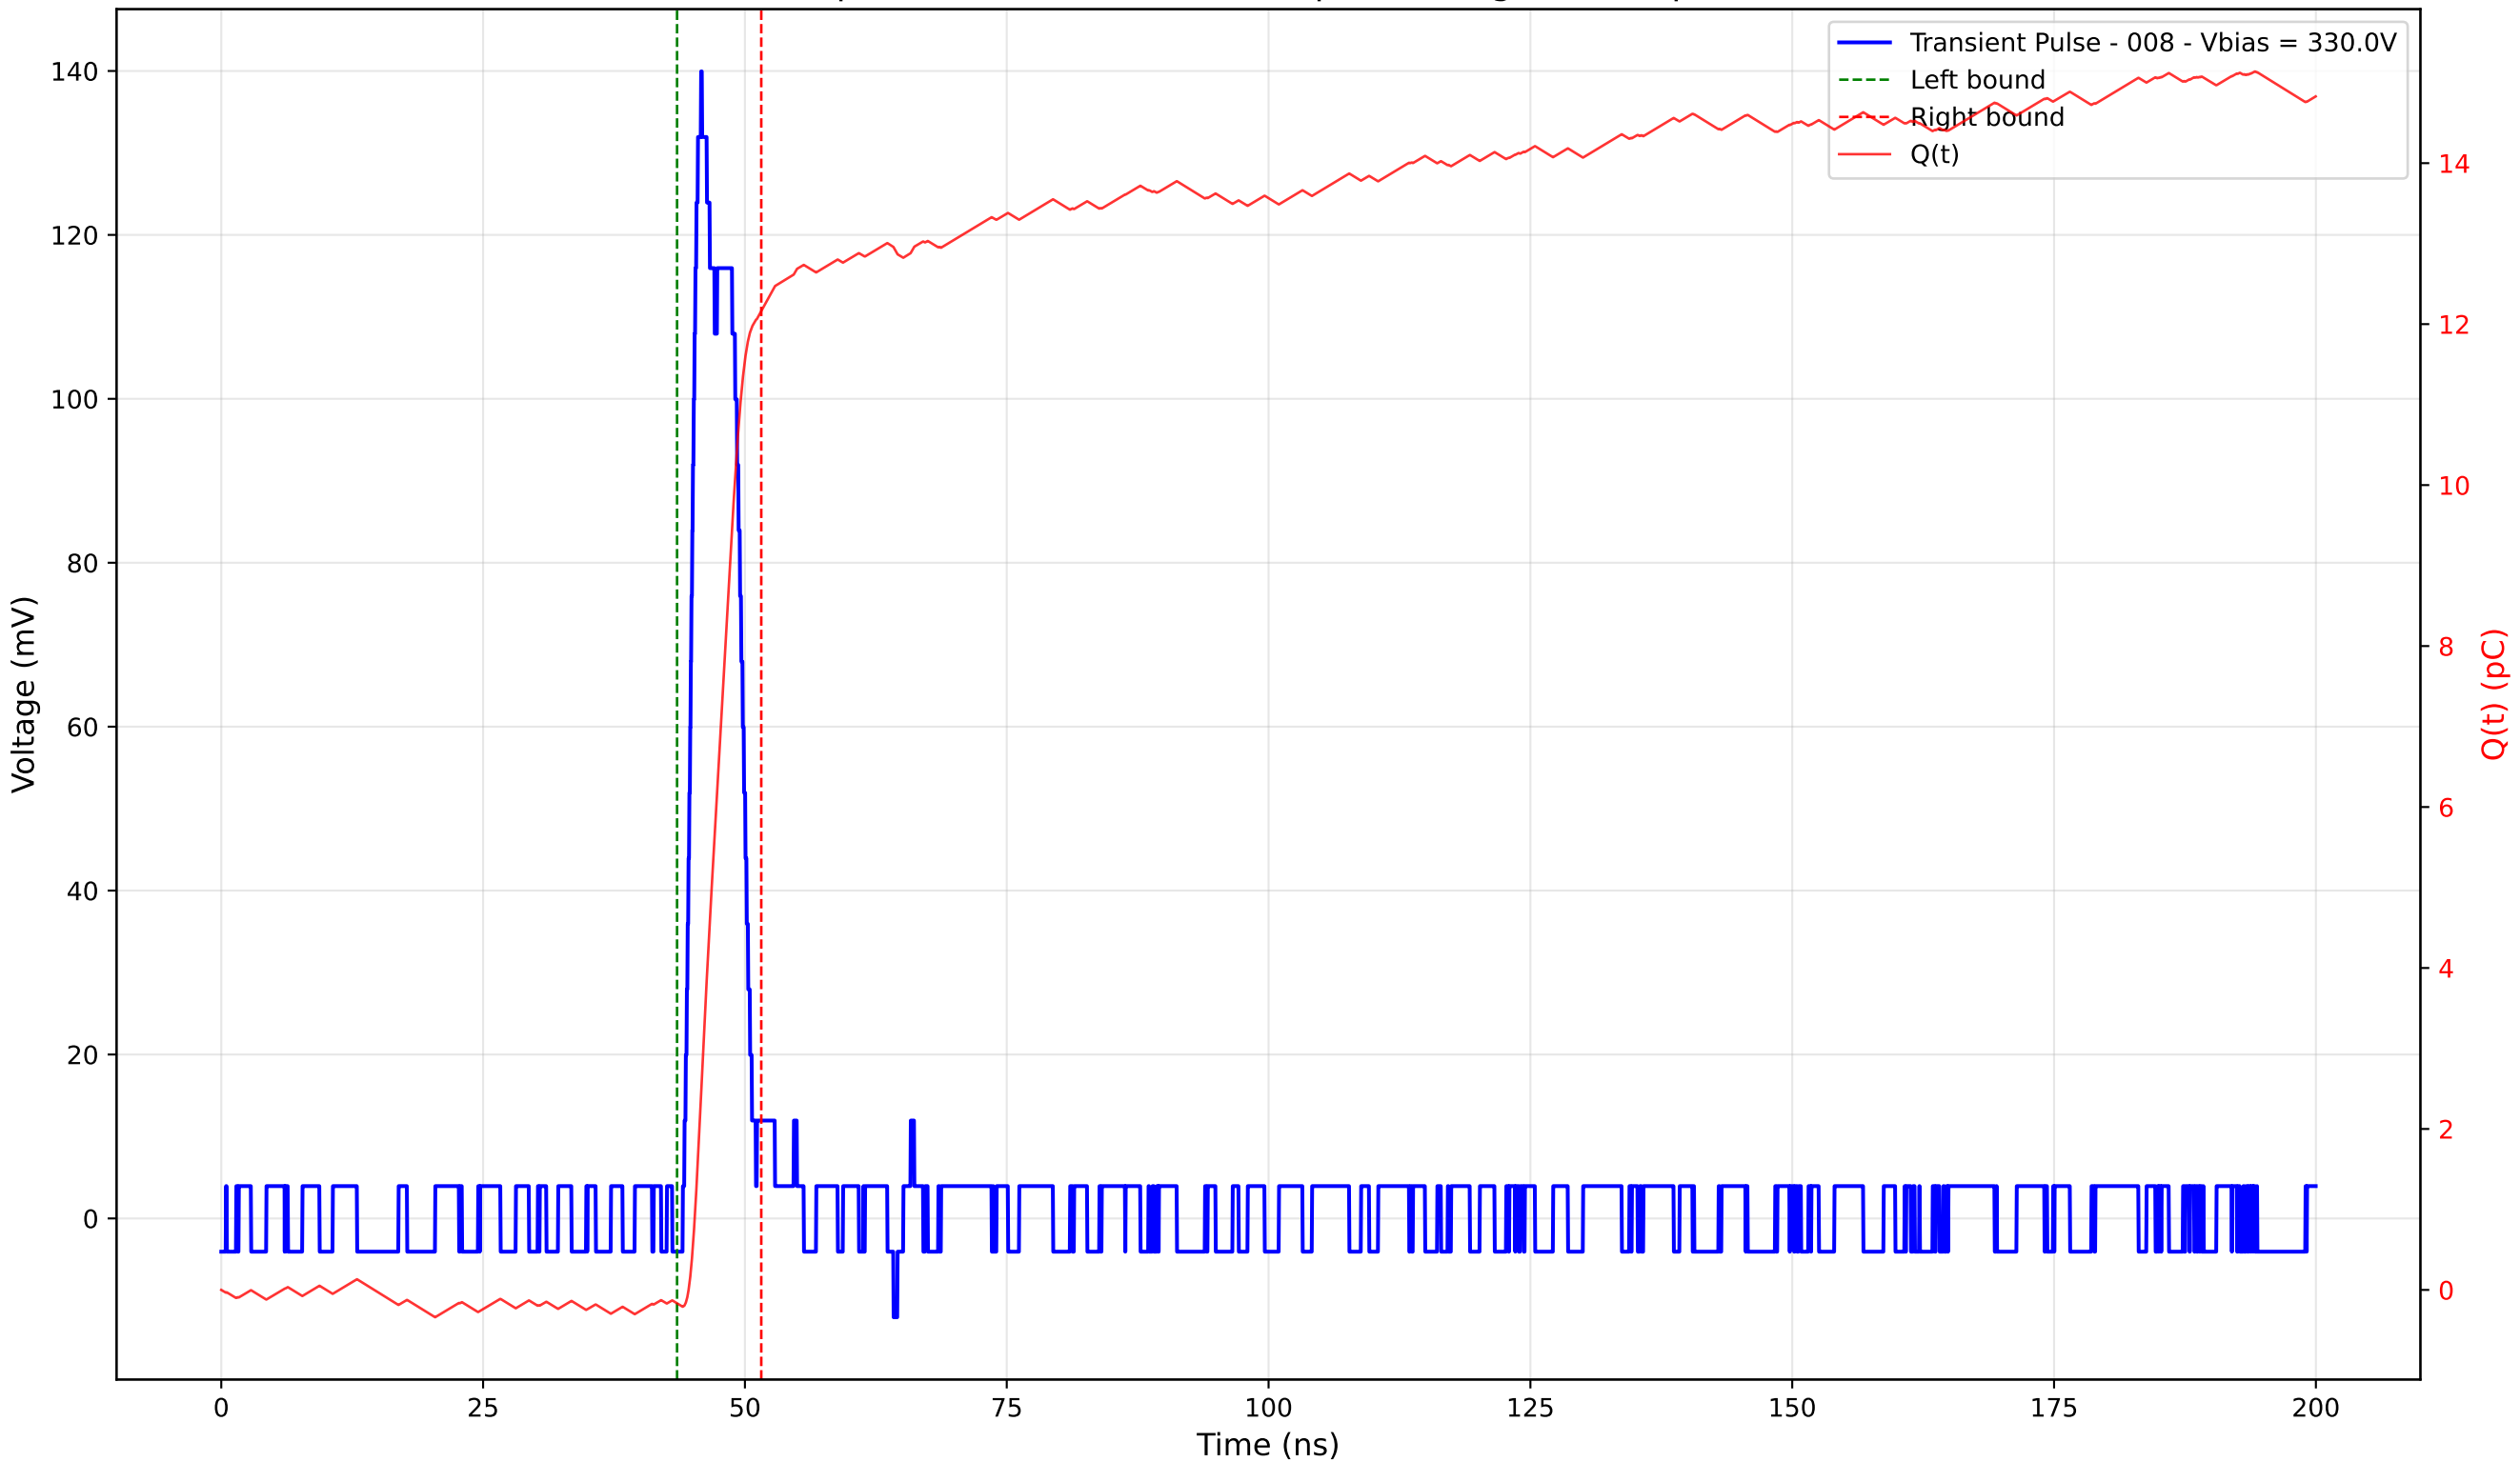


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 7.32 pC - Rise Time: 0.94 ns

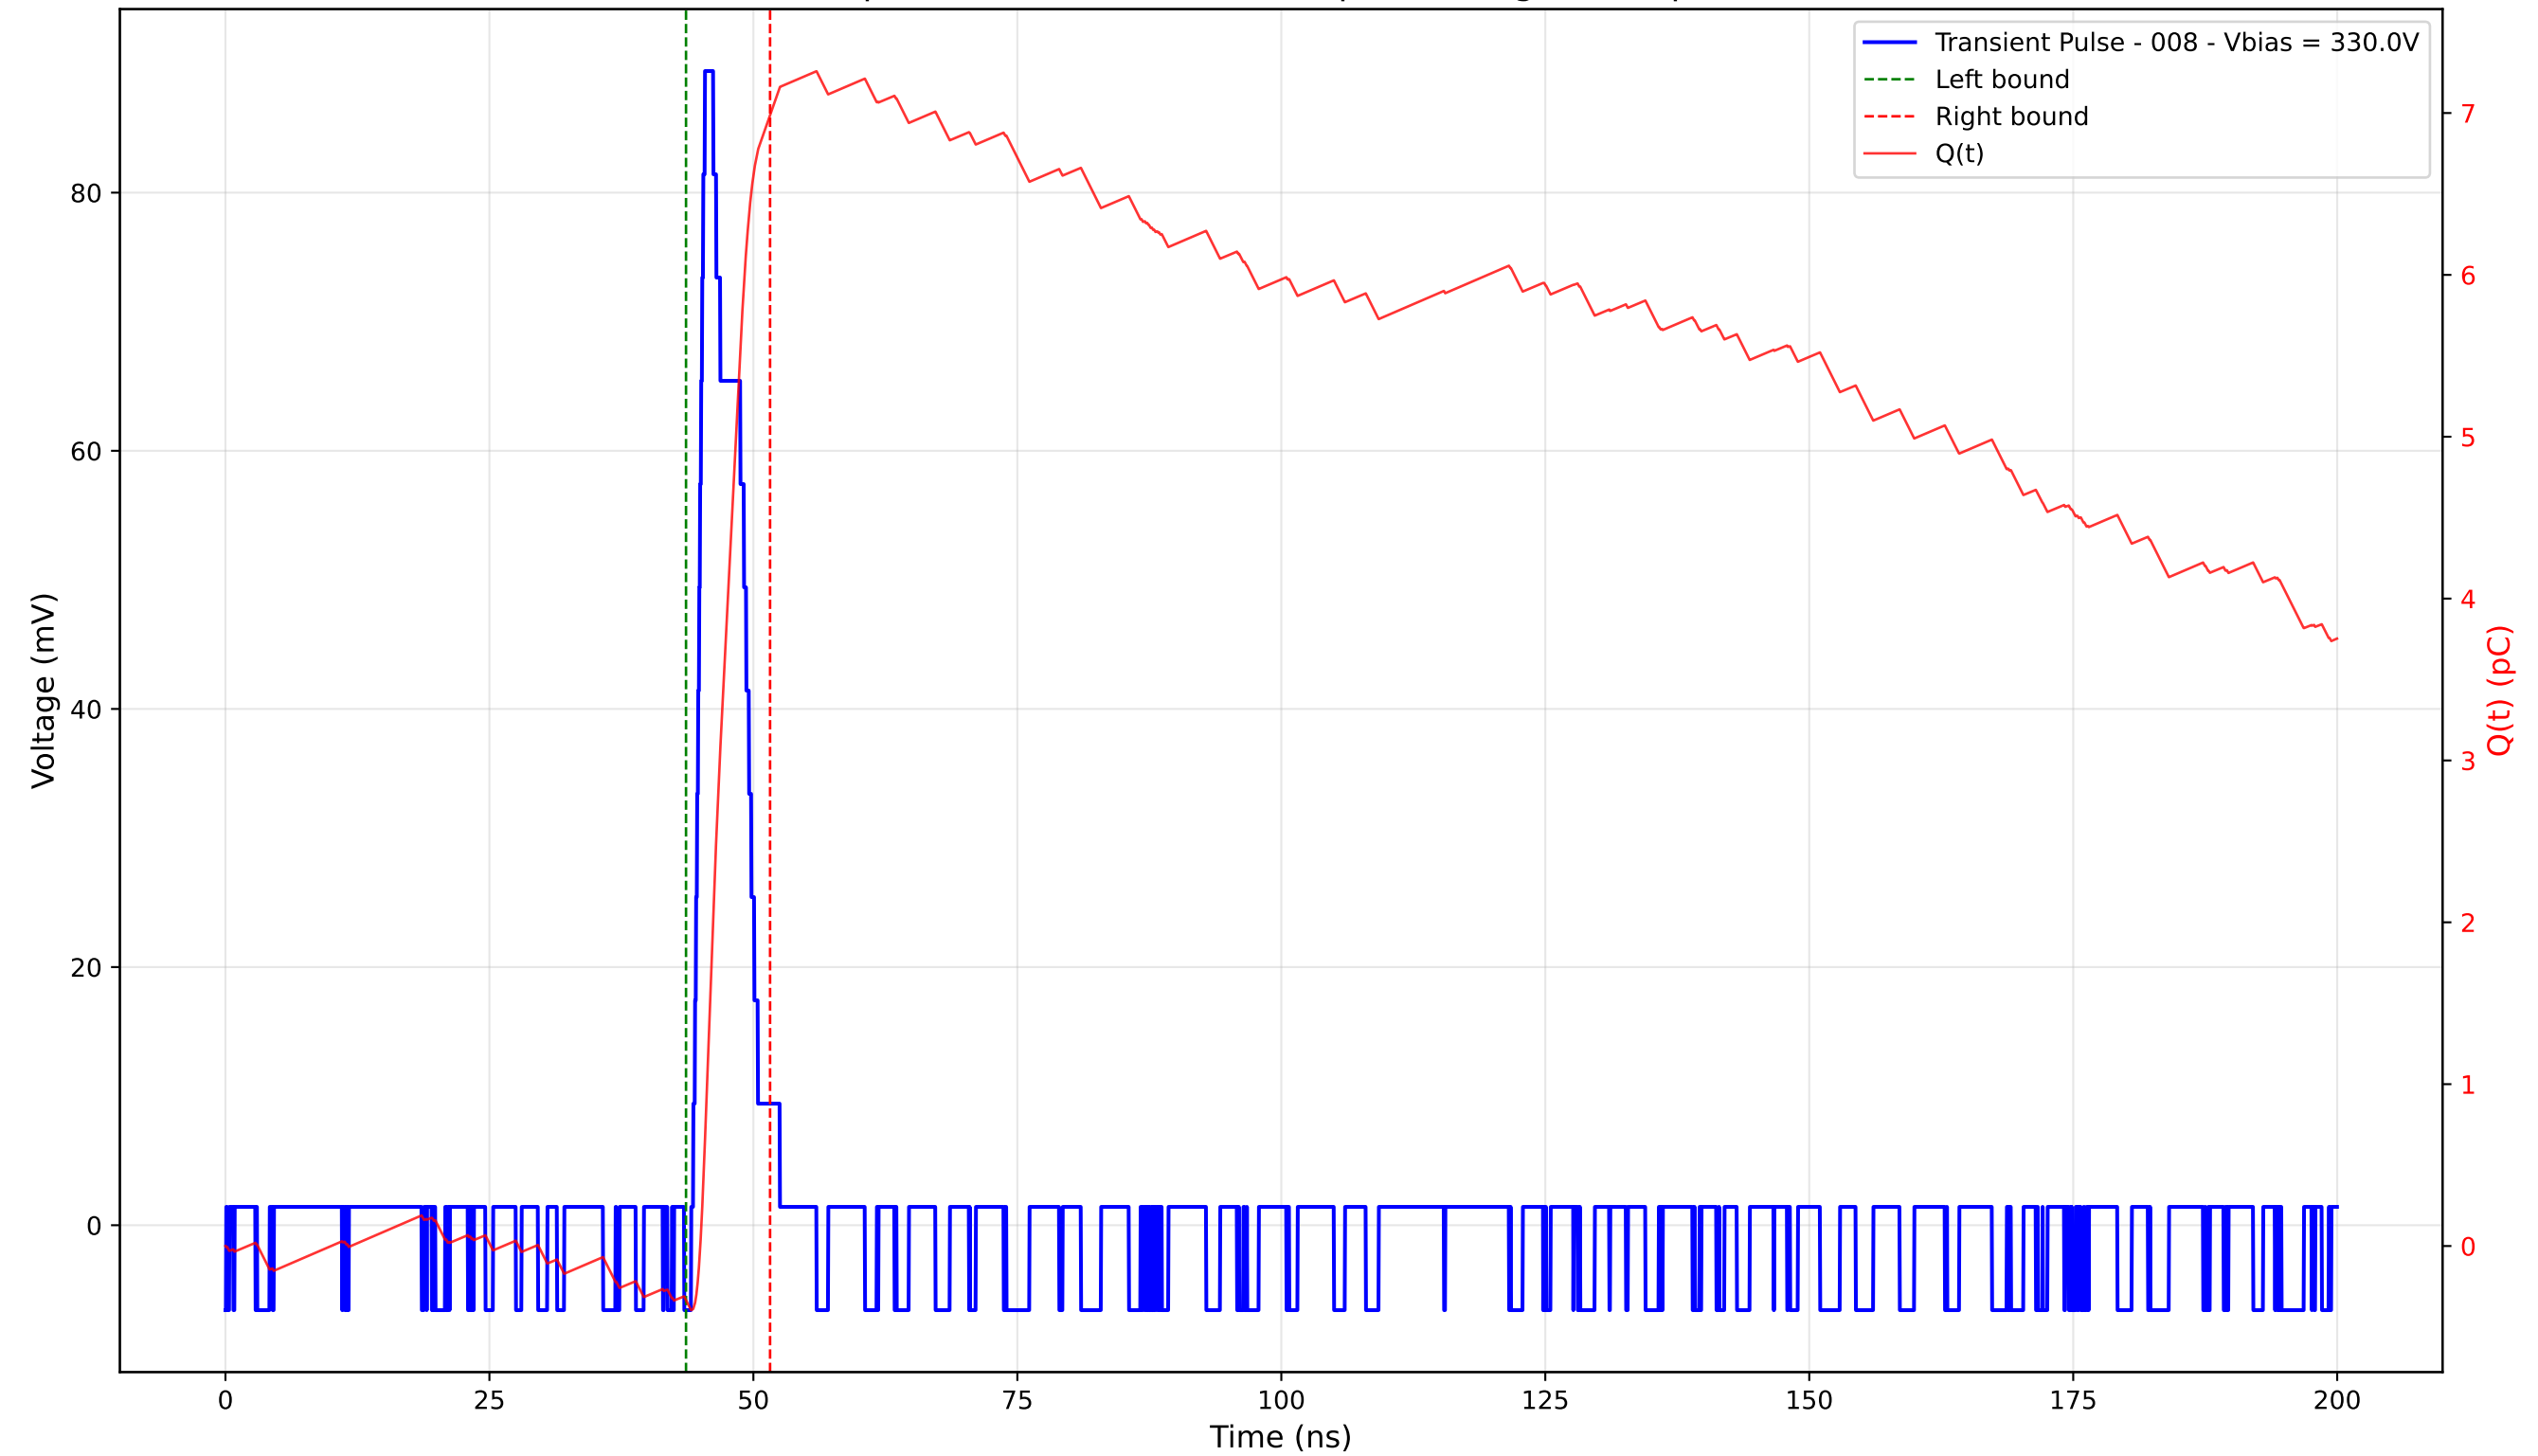


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 3.79 pC - Rise Time: 1.29 ns

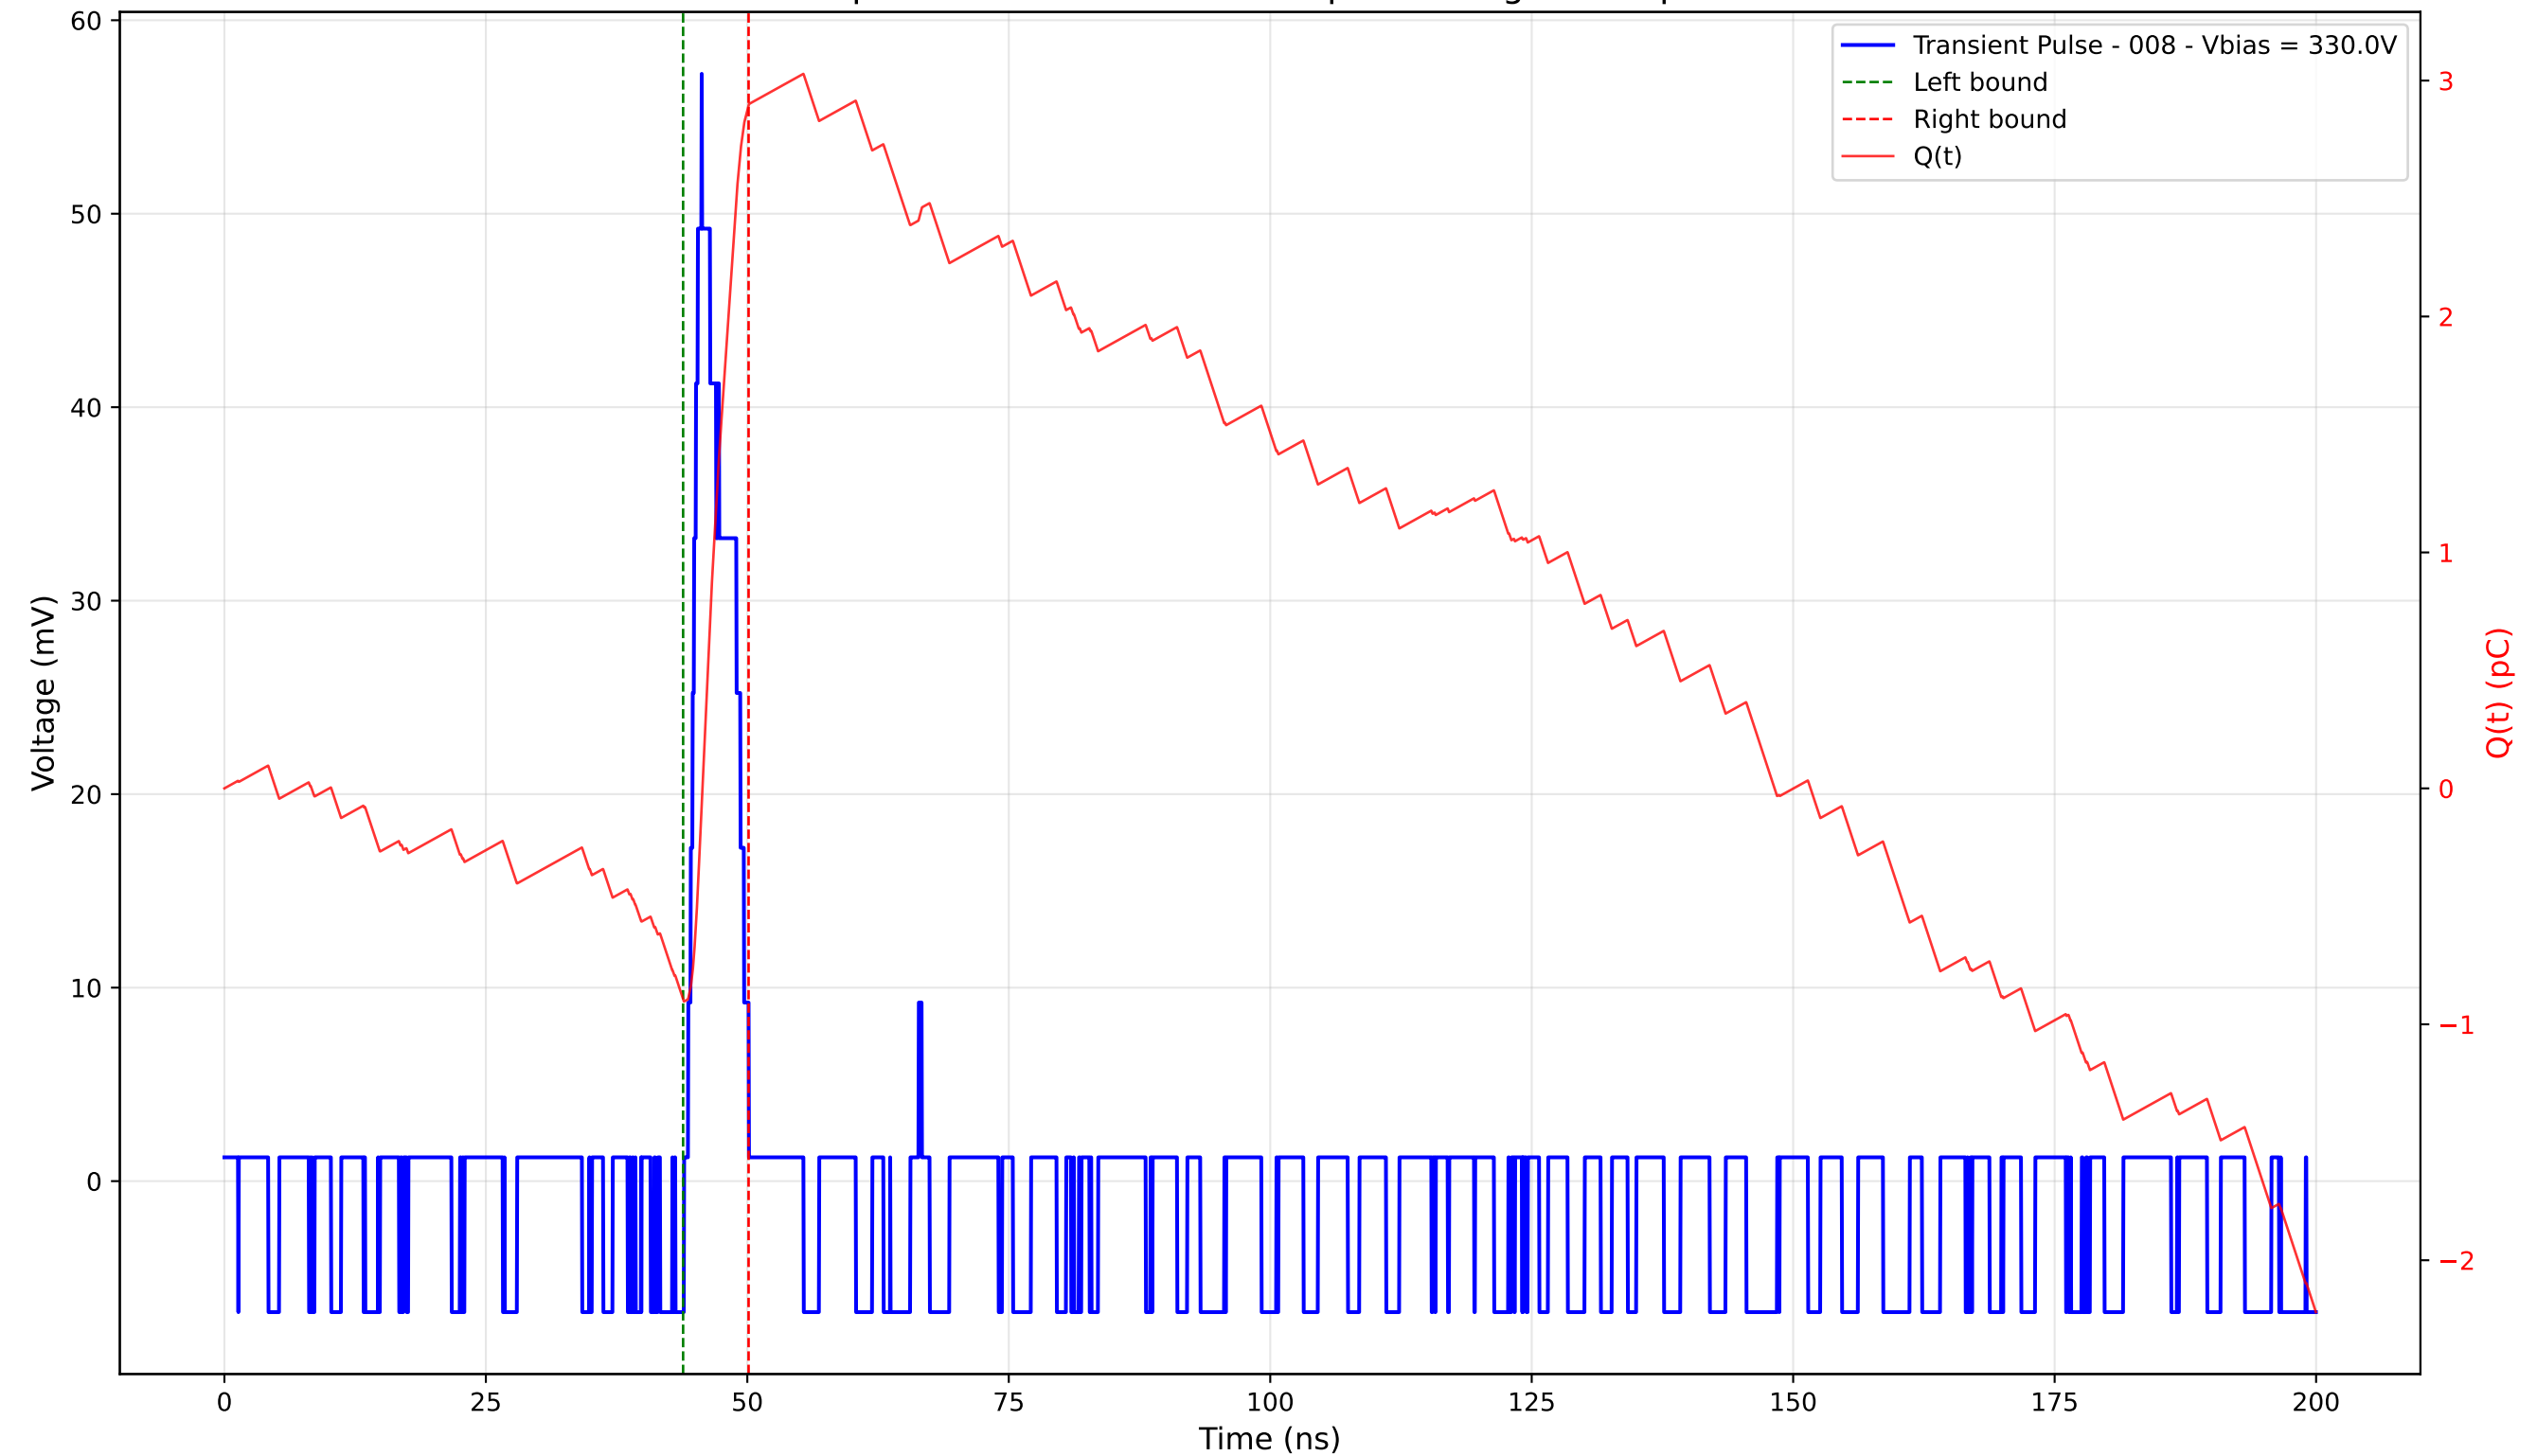

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.90 pC - Rise Time: 0.70 ns

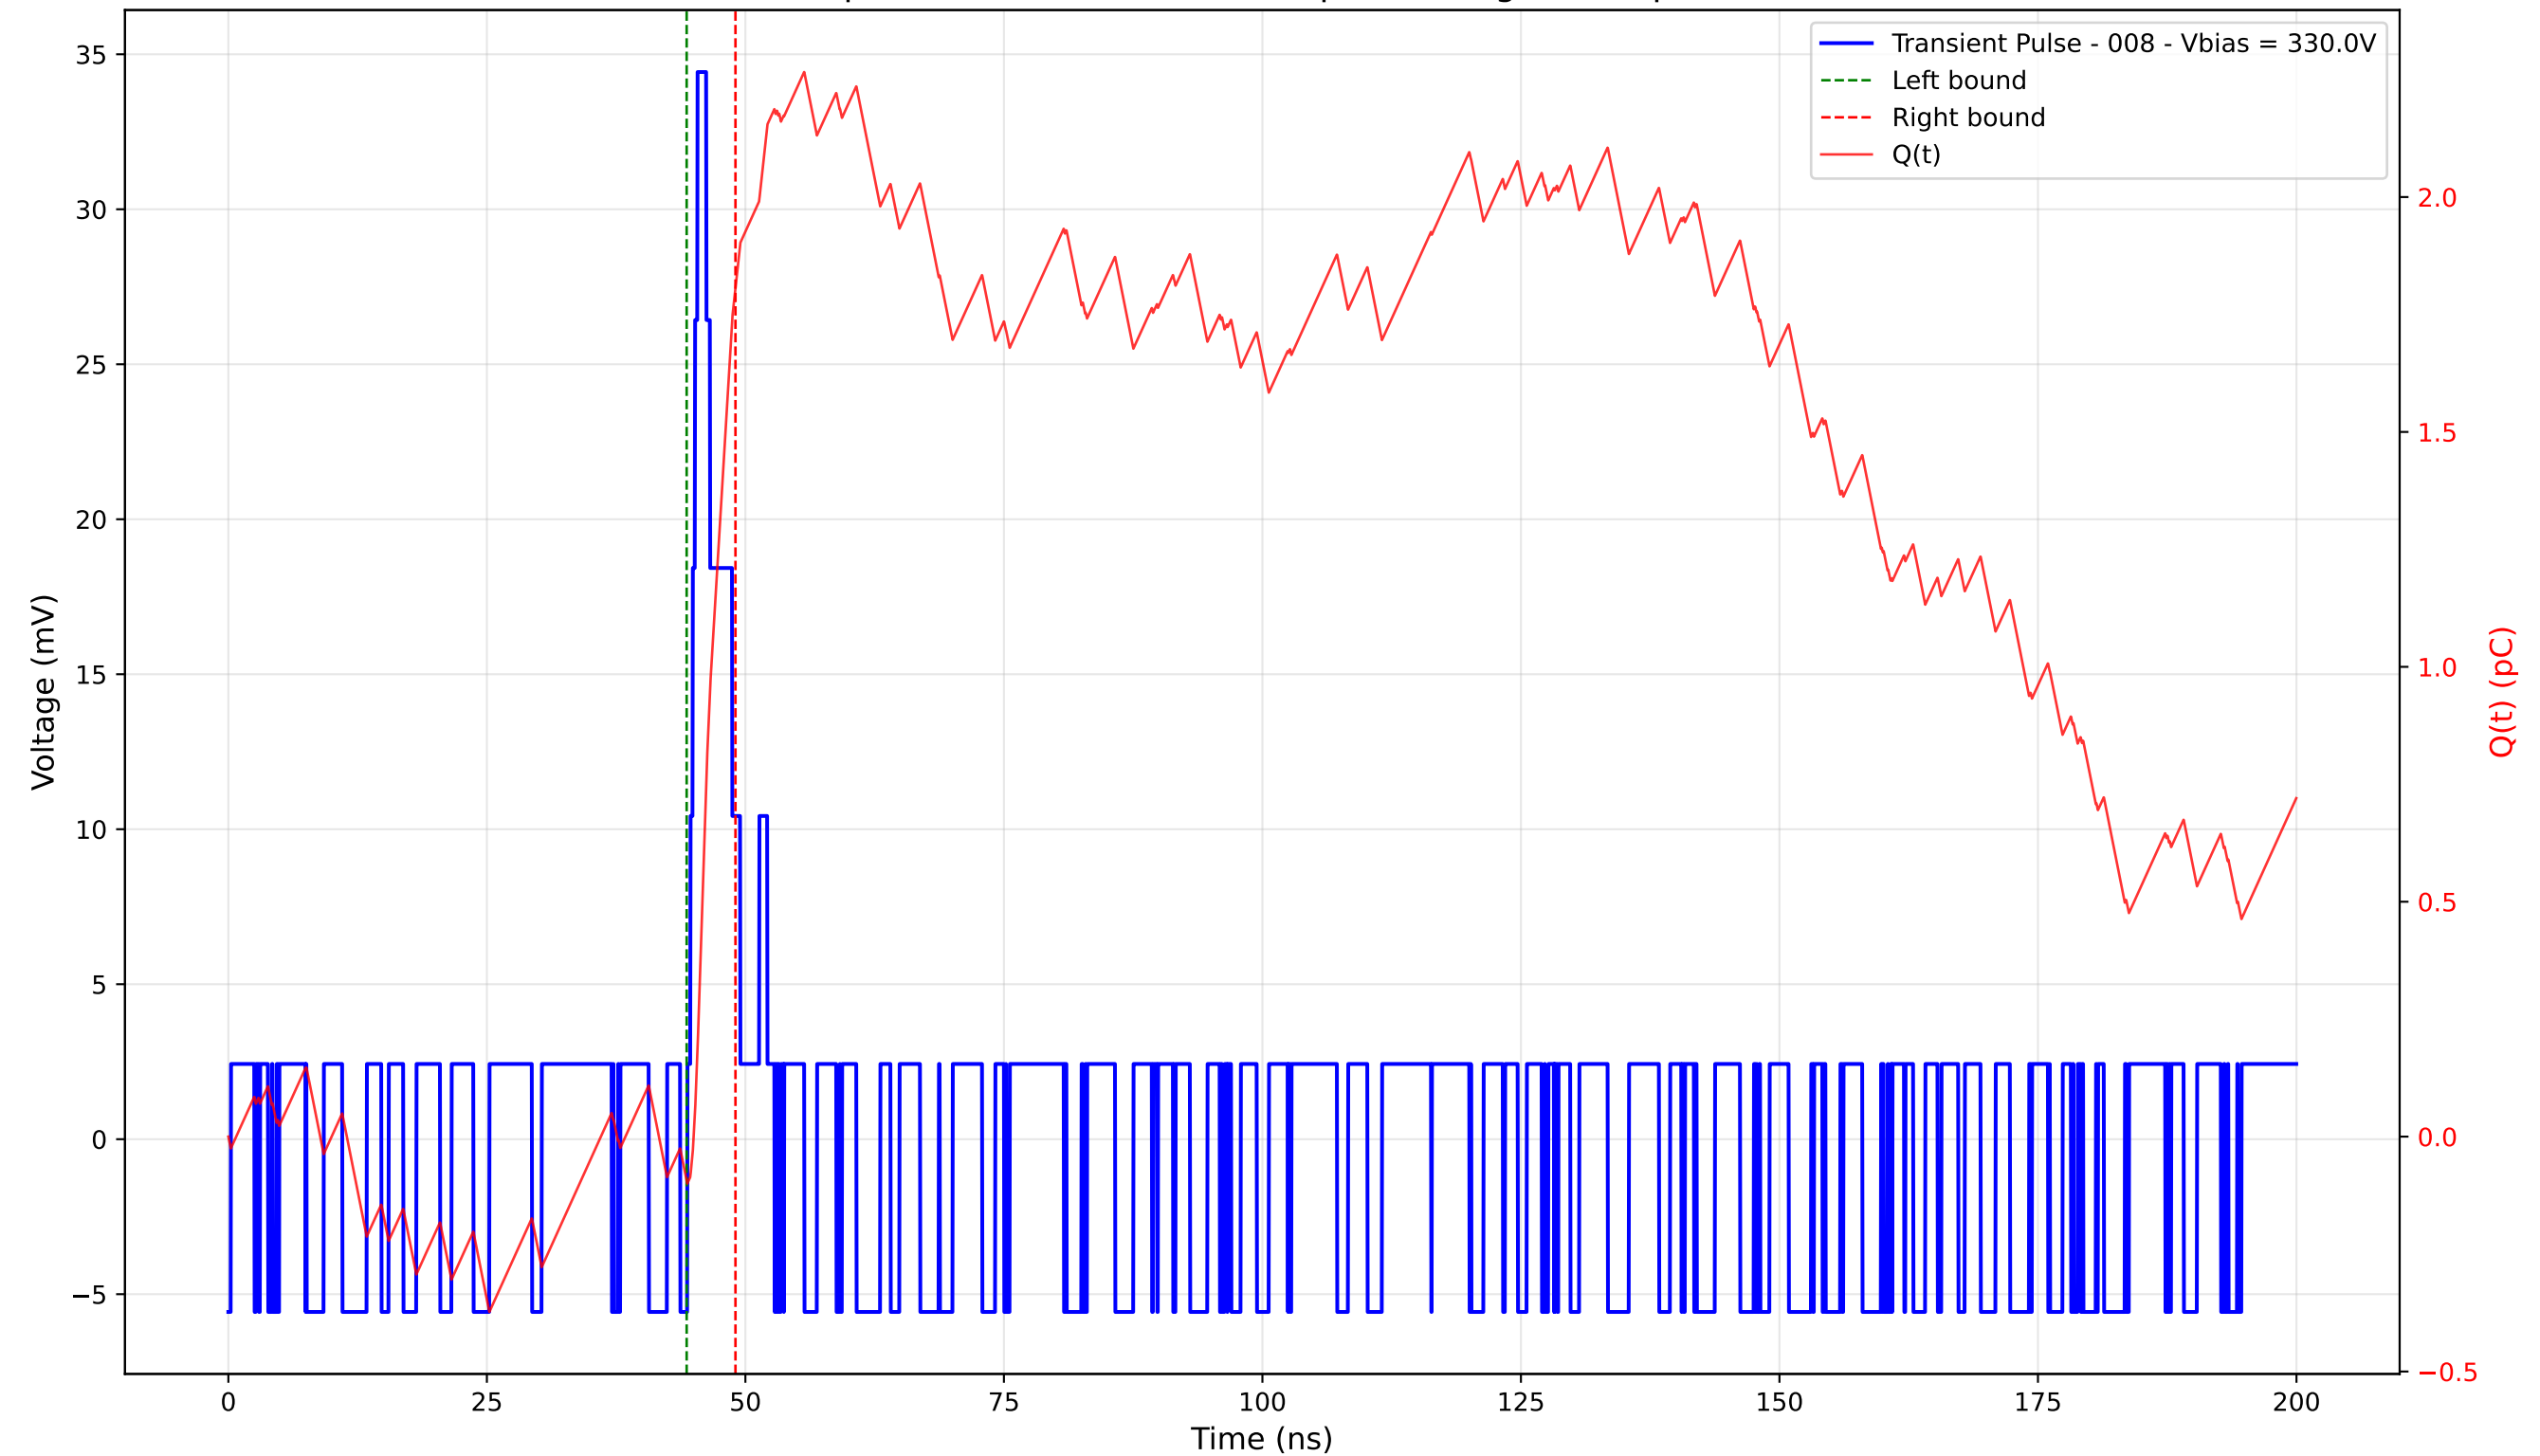

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 1.01 pC - Rise Time: 0.96 ns

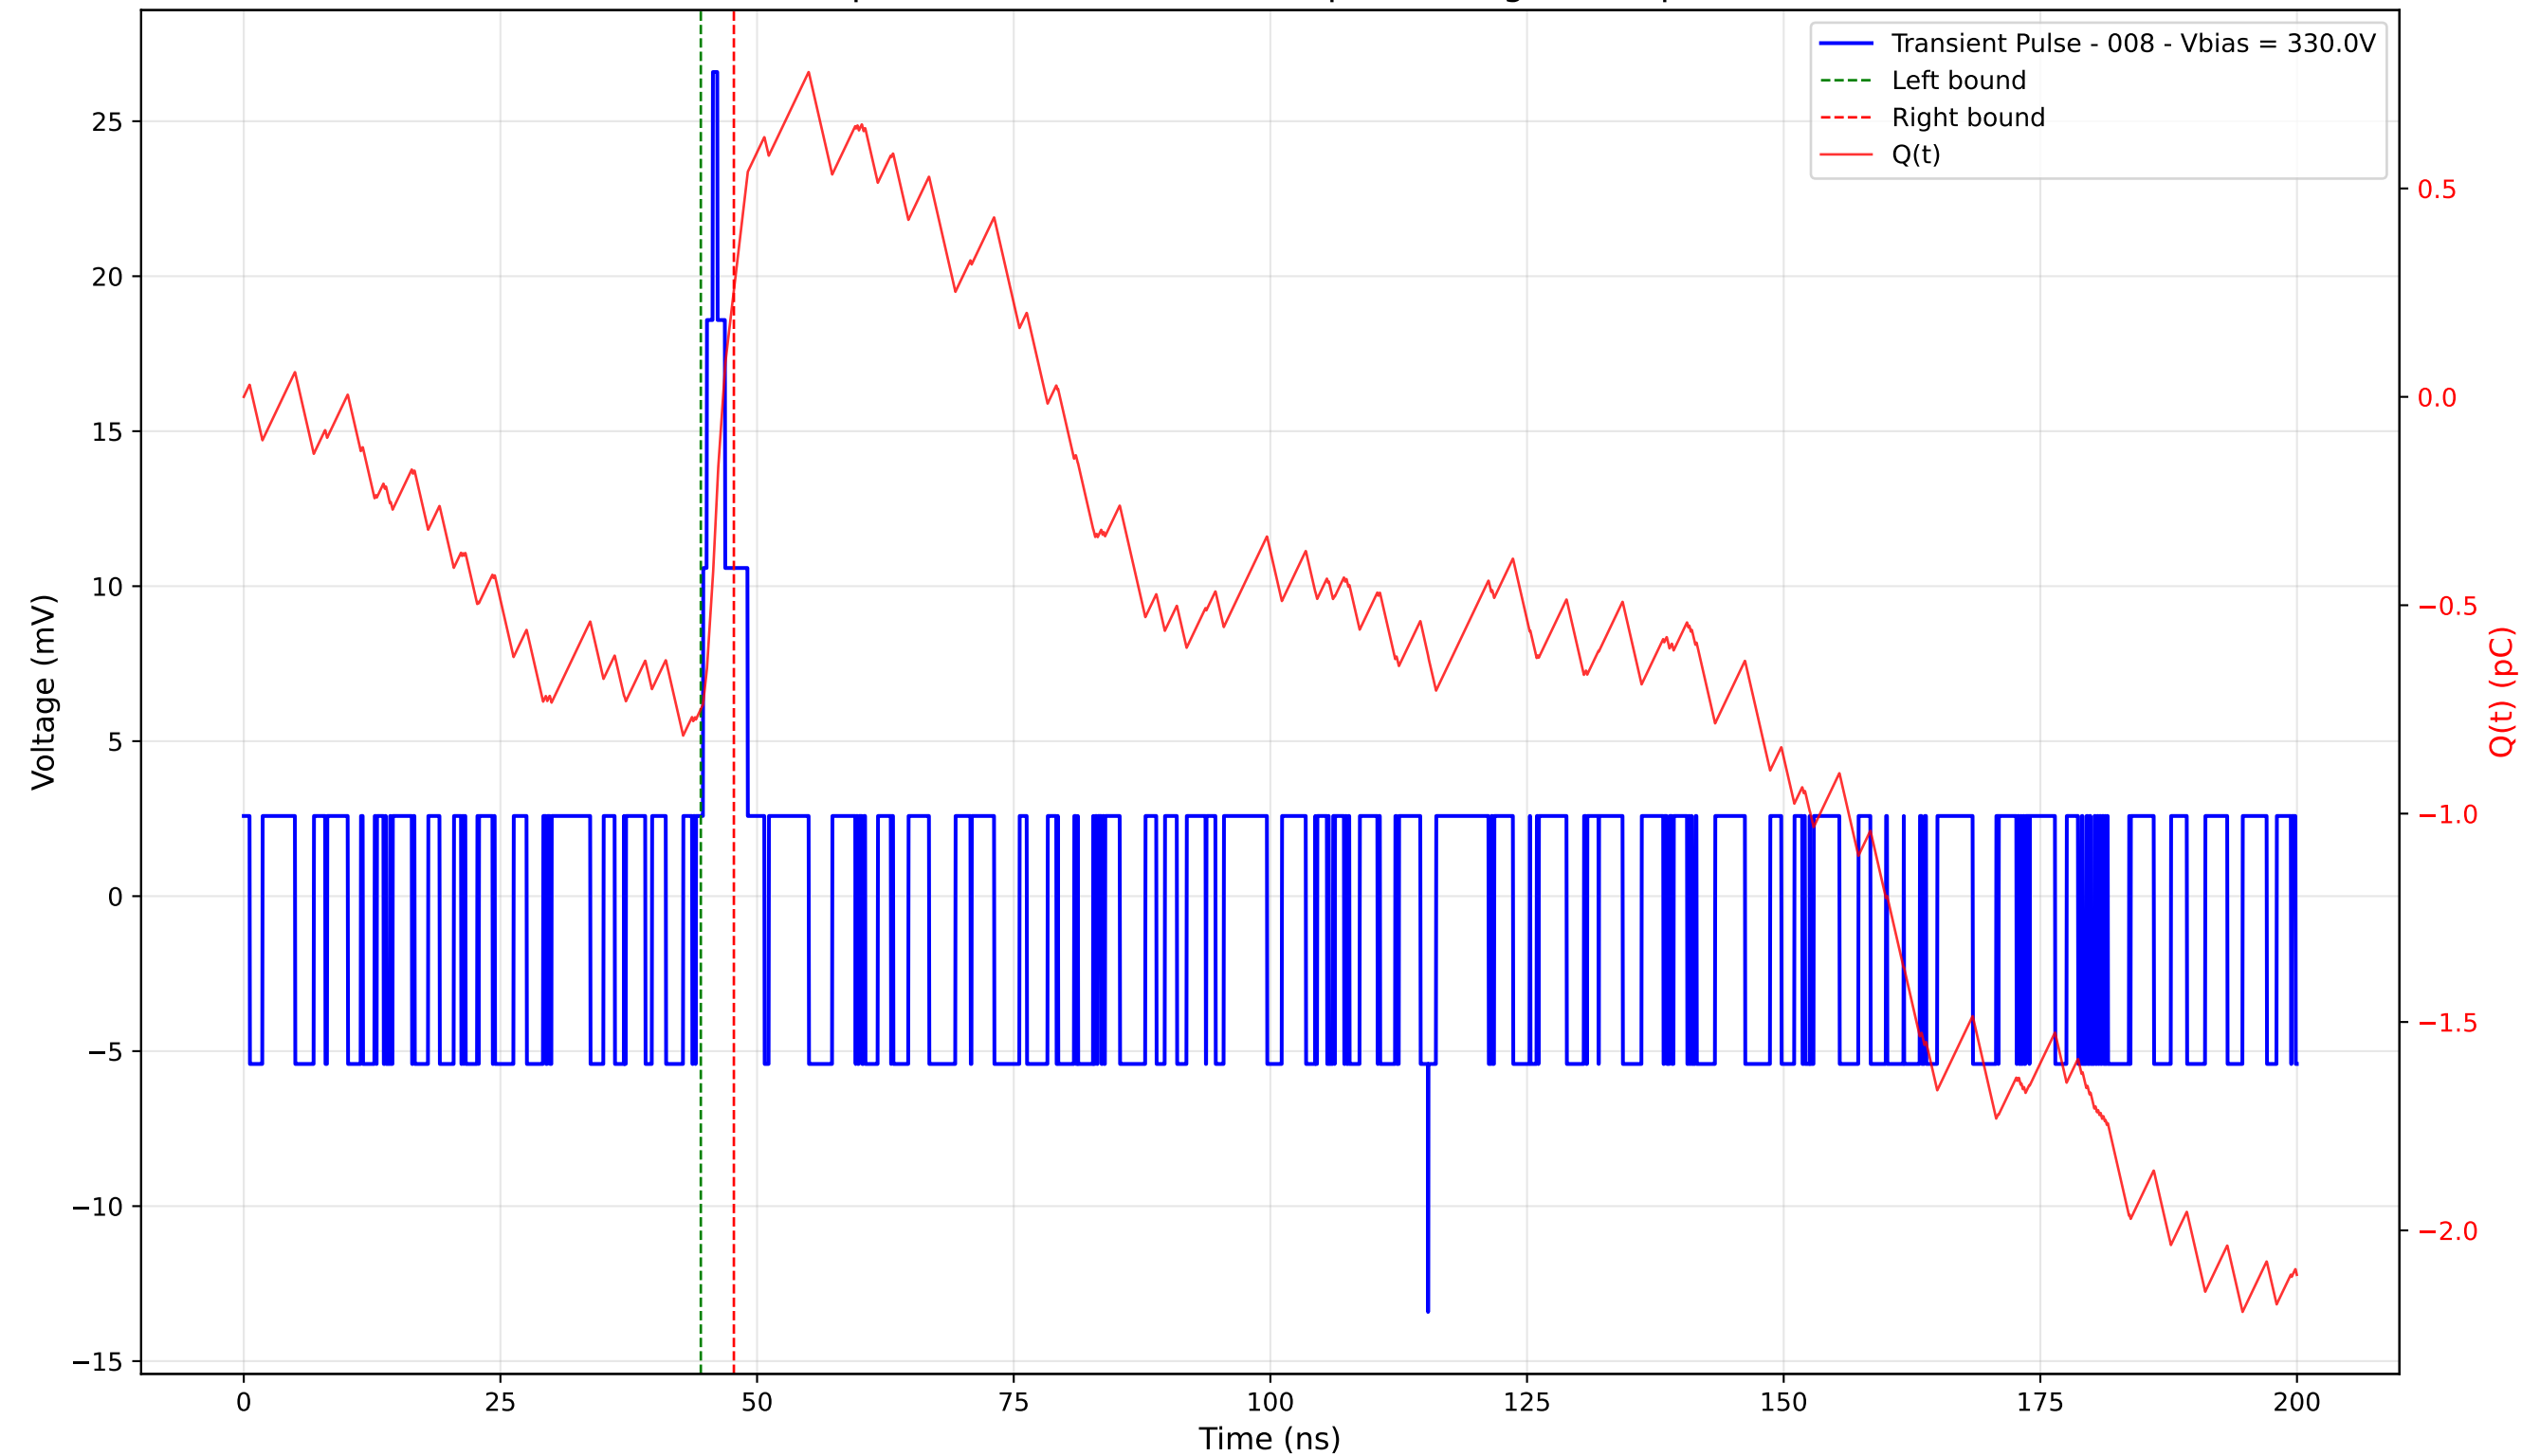

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.95 pC - Rise Time: 0.00 ns (N/A)

