


TCT Run 009 Summary

Parameter	Value
Run	Run009
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	310.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\310V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

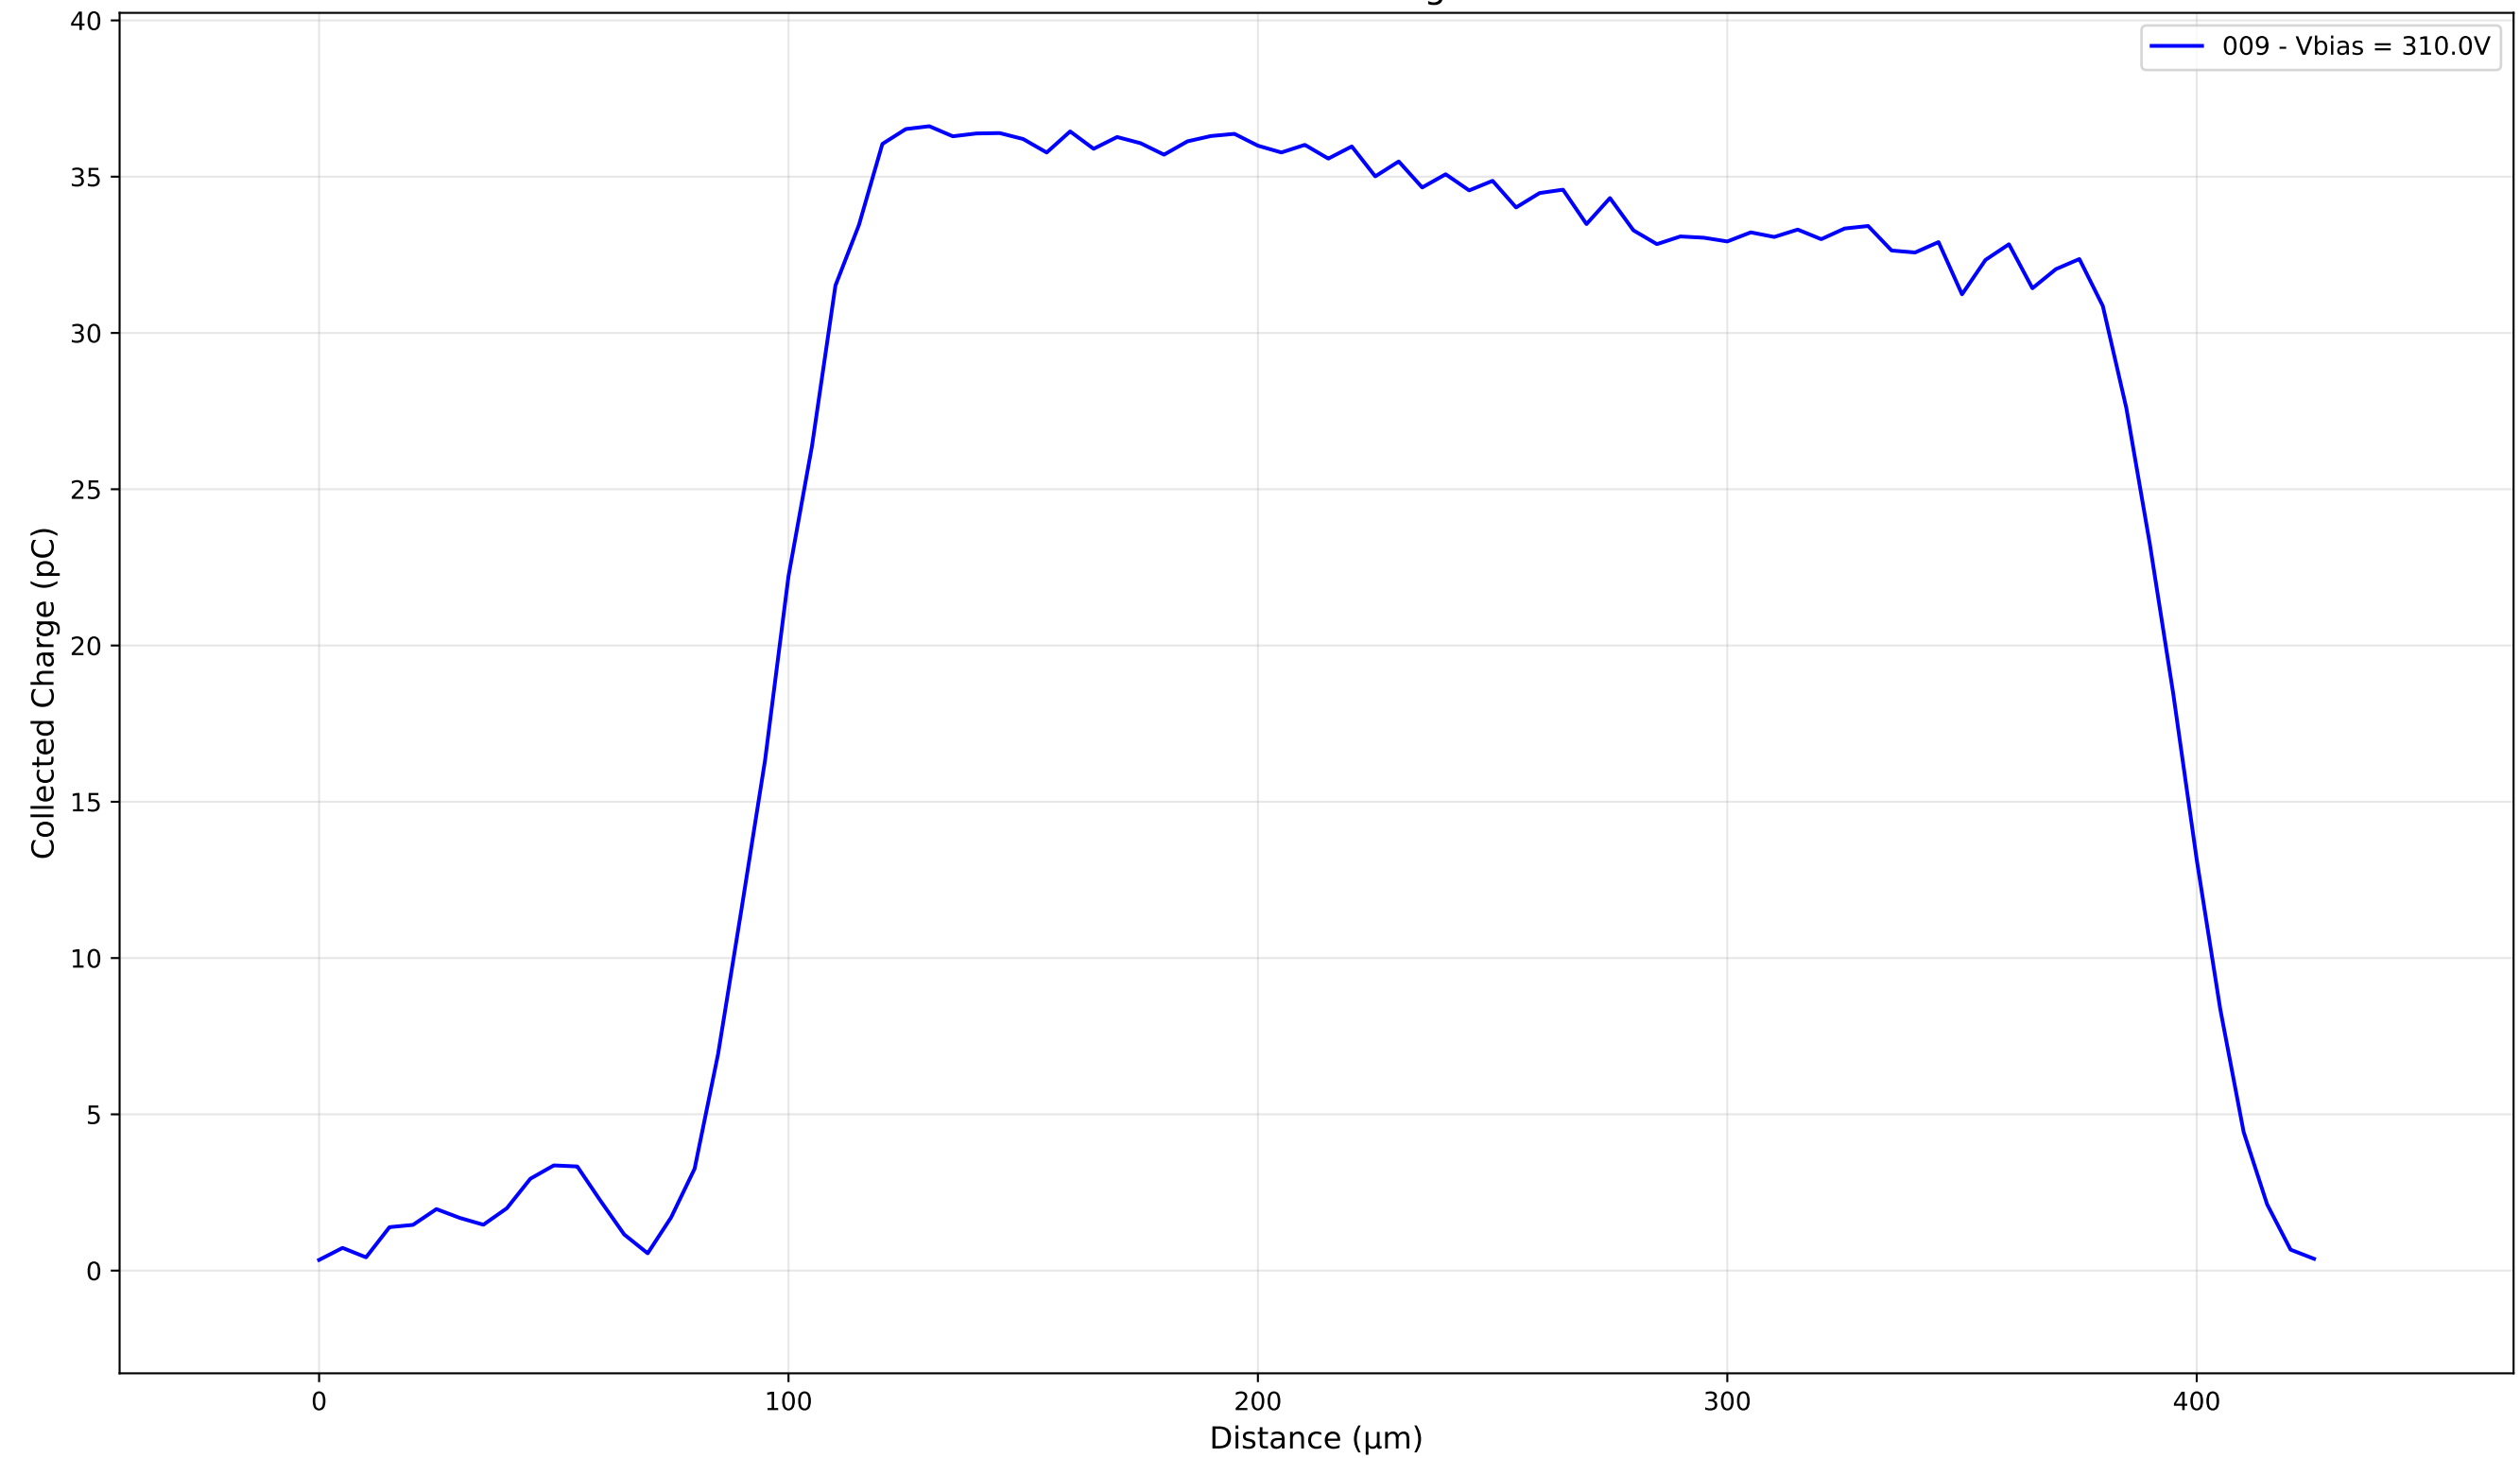

Collected Charge

009 - Vbias = 310.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

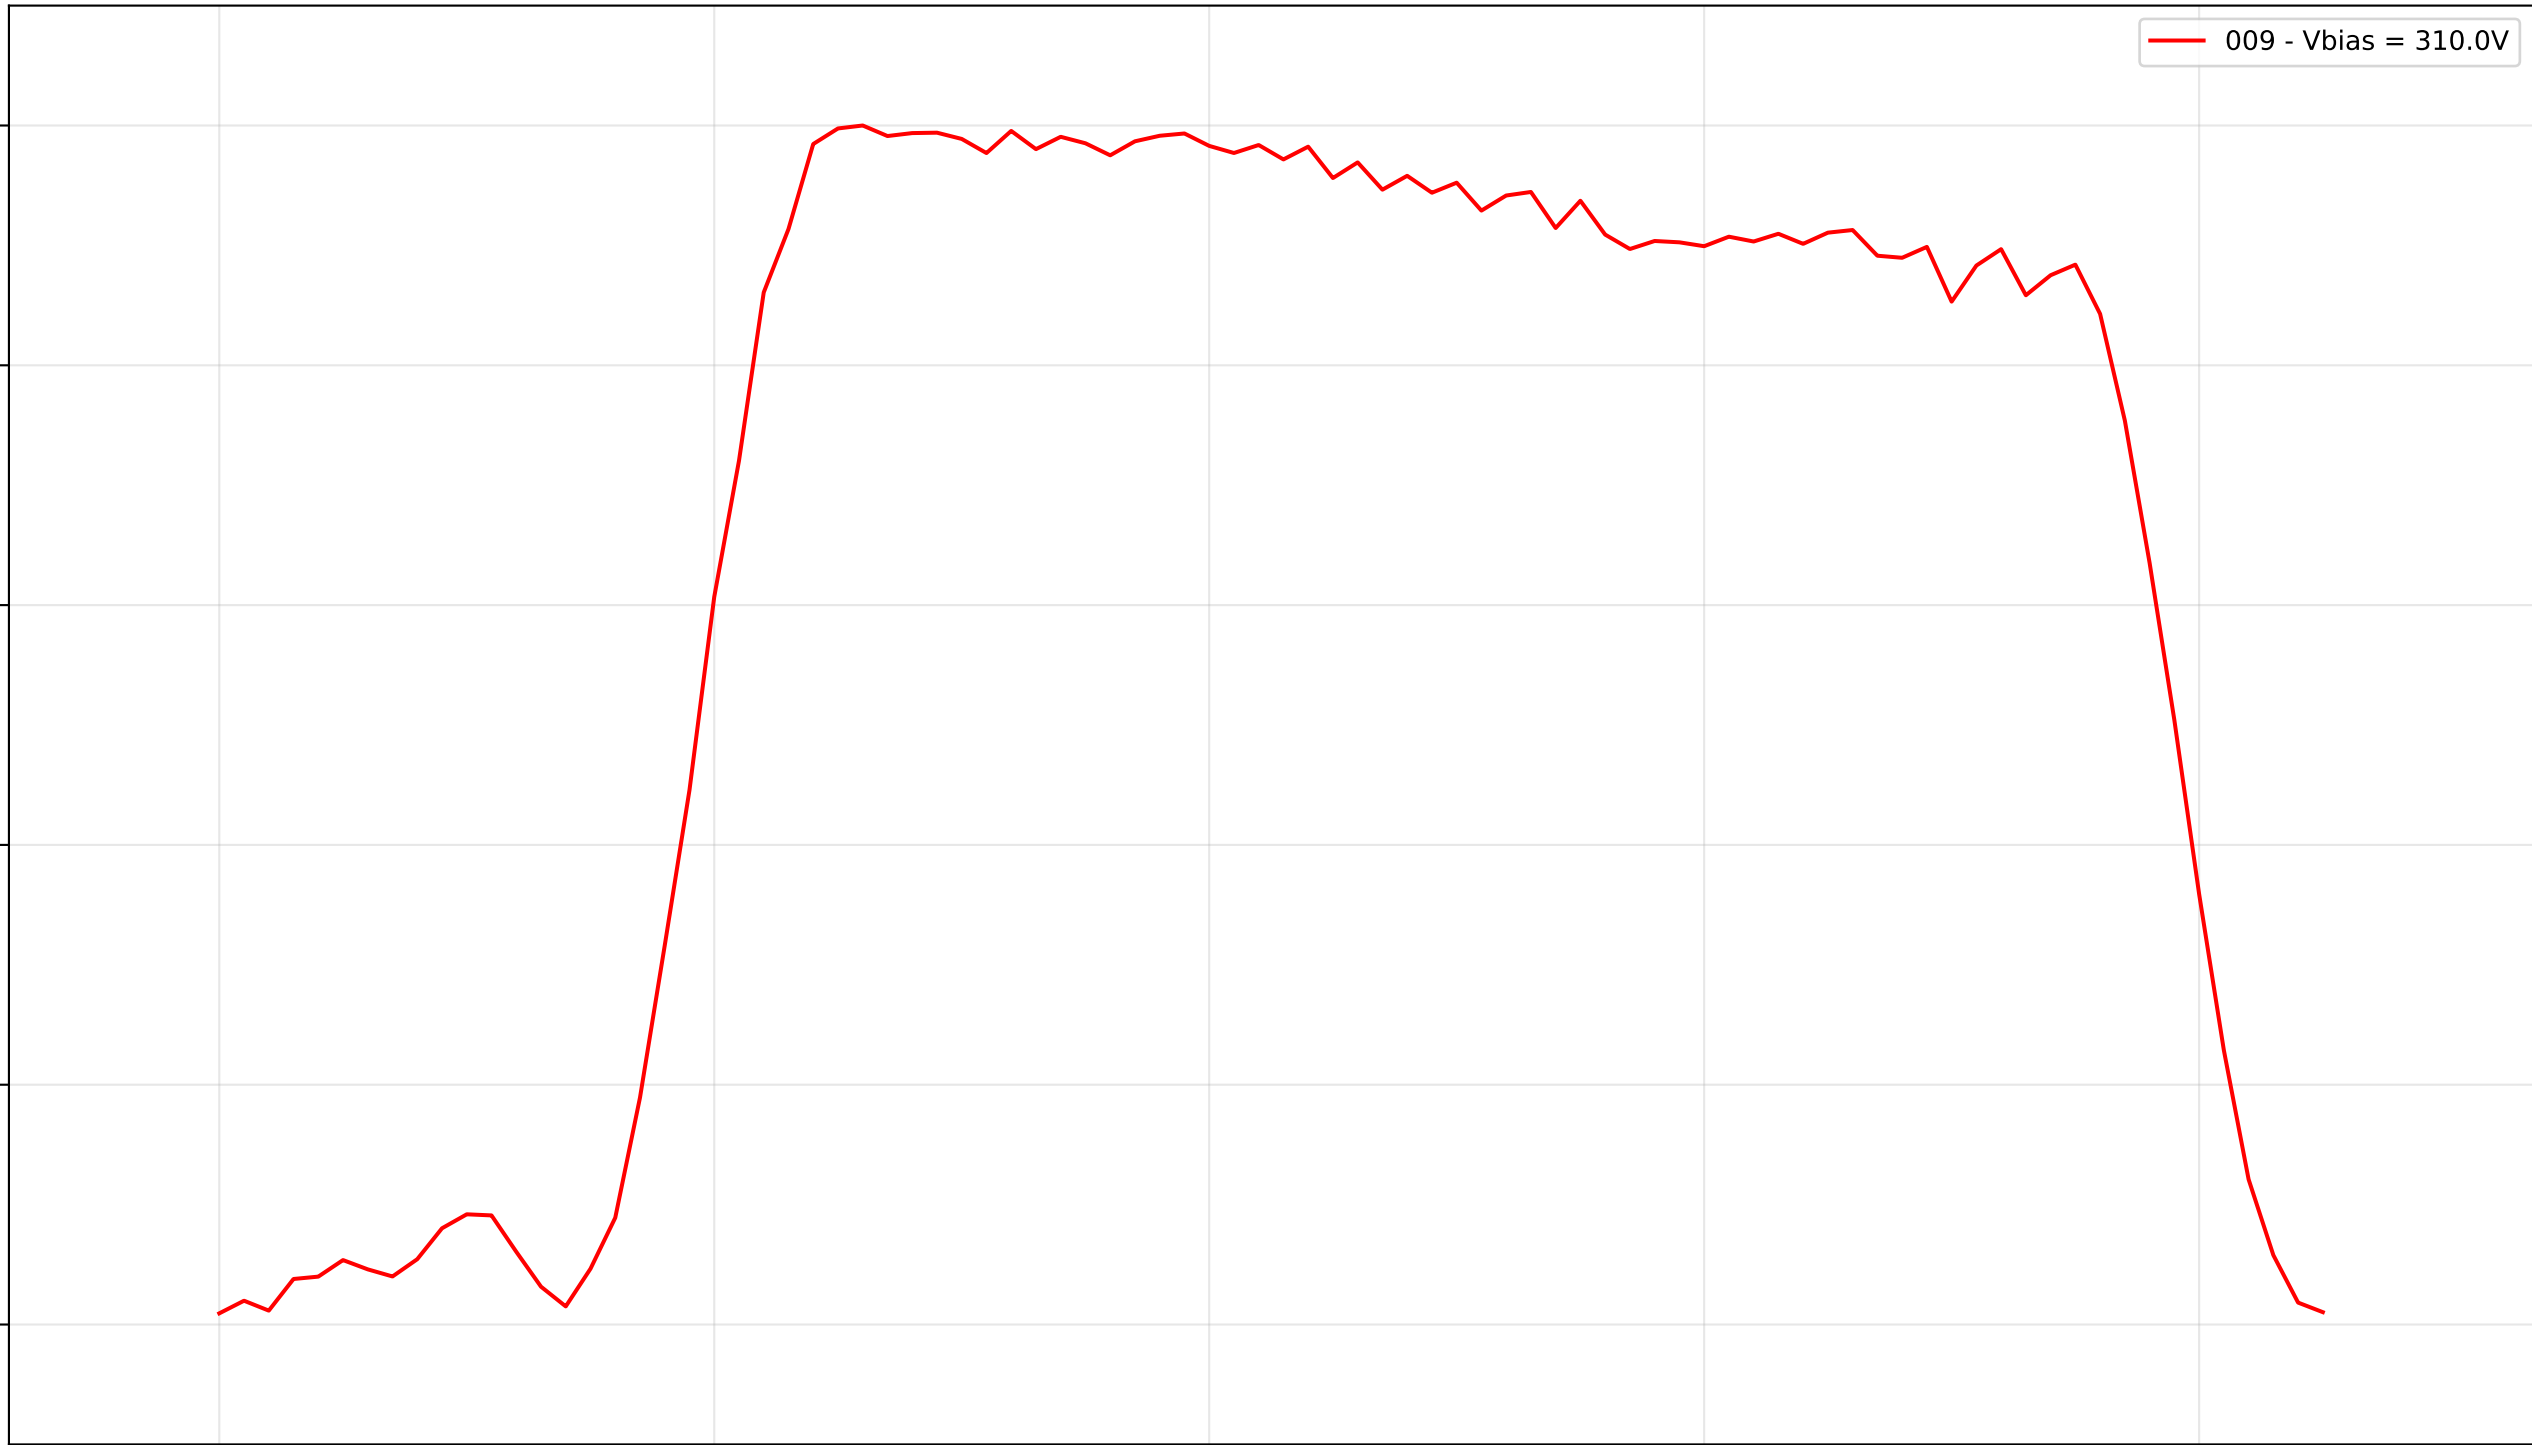


Rise Time

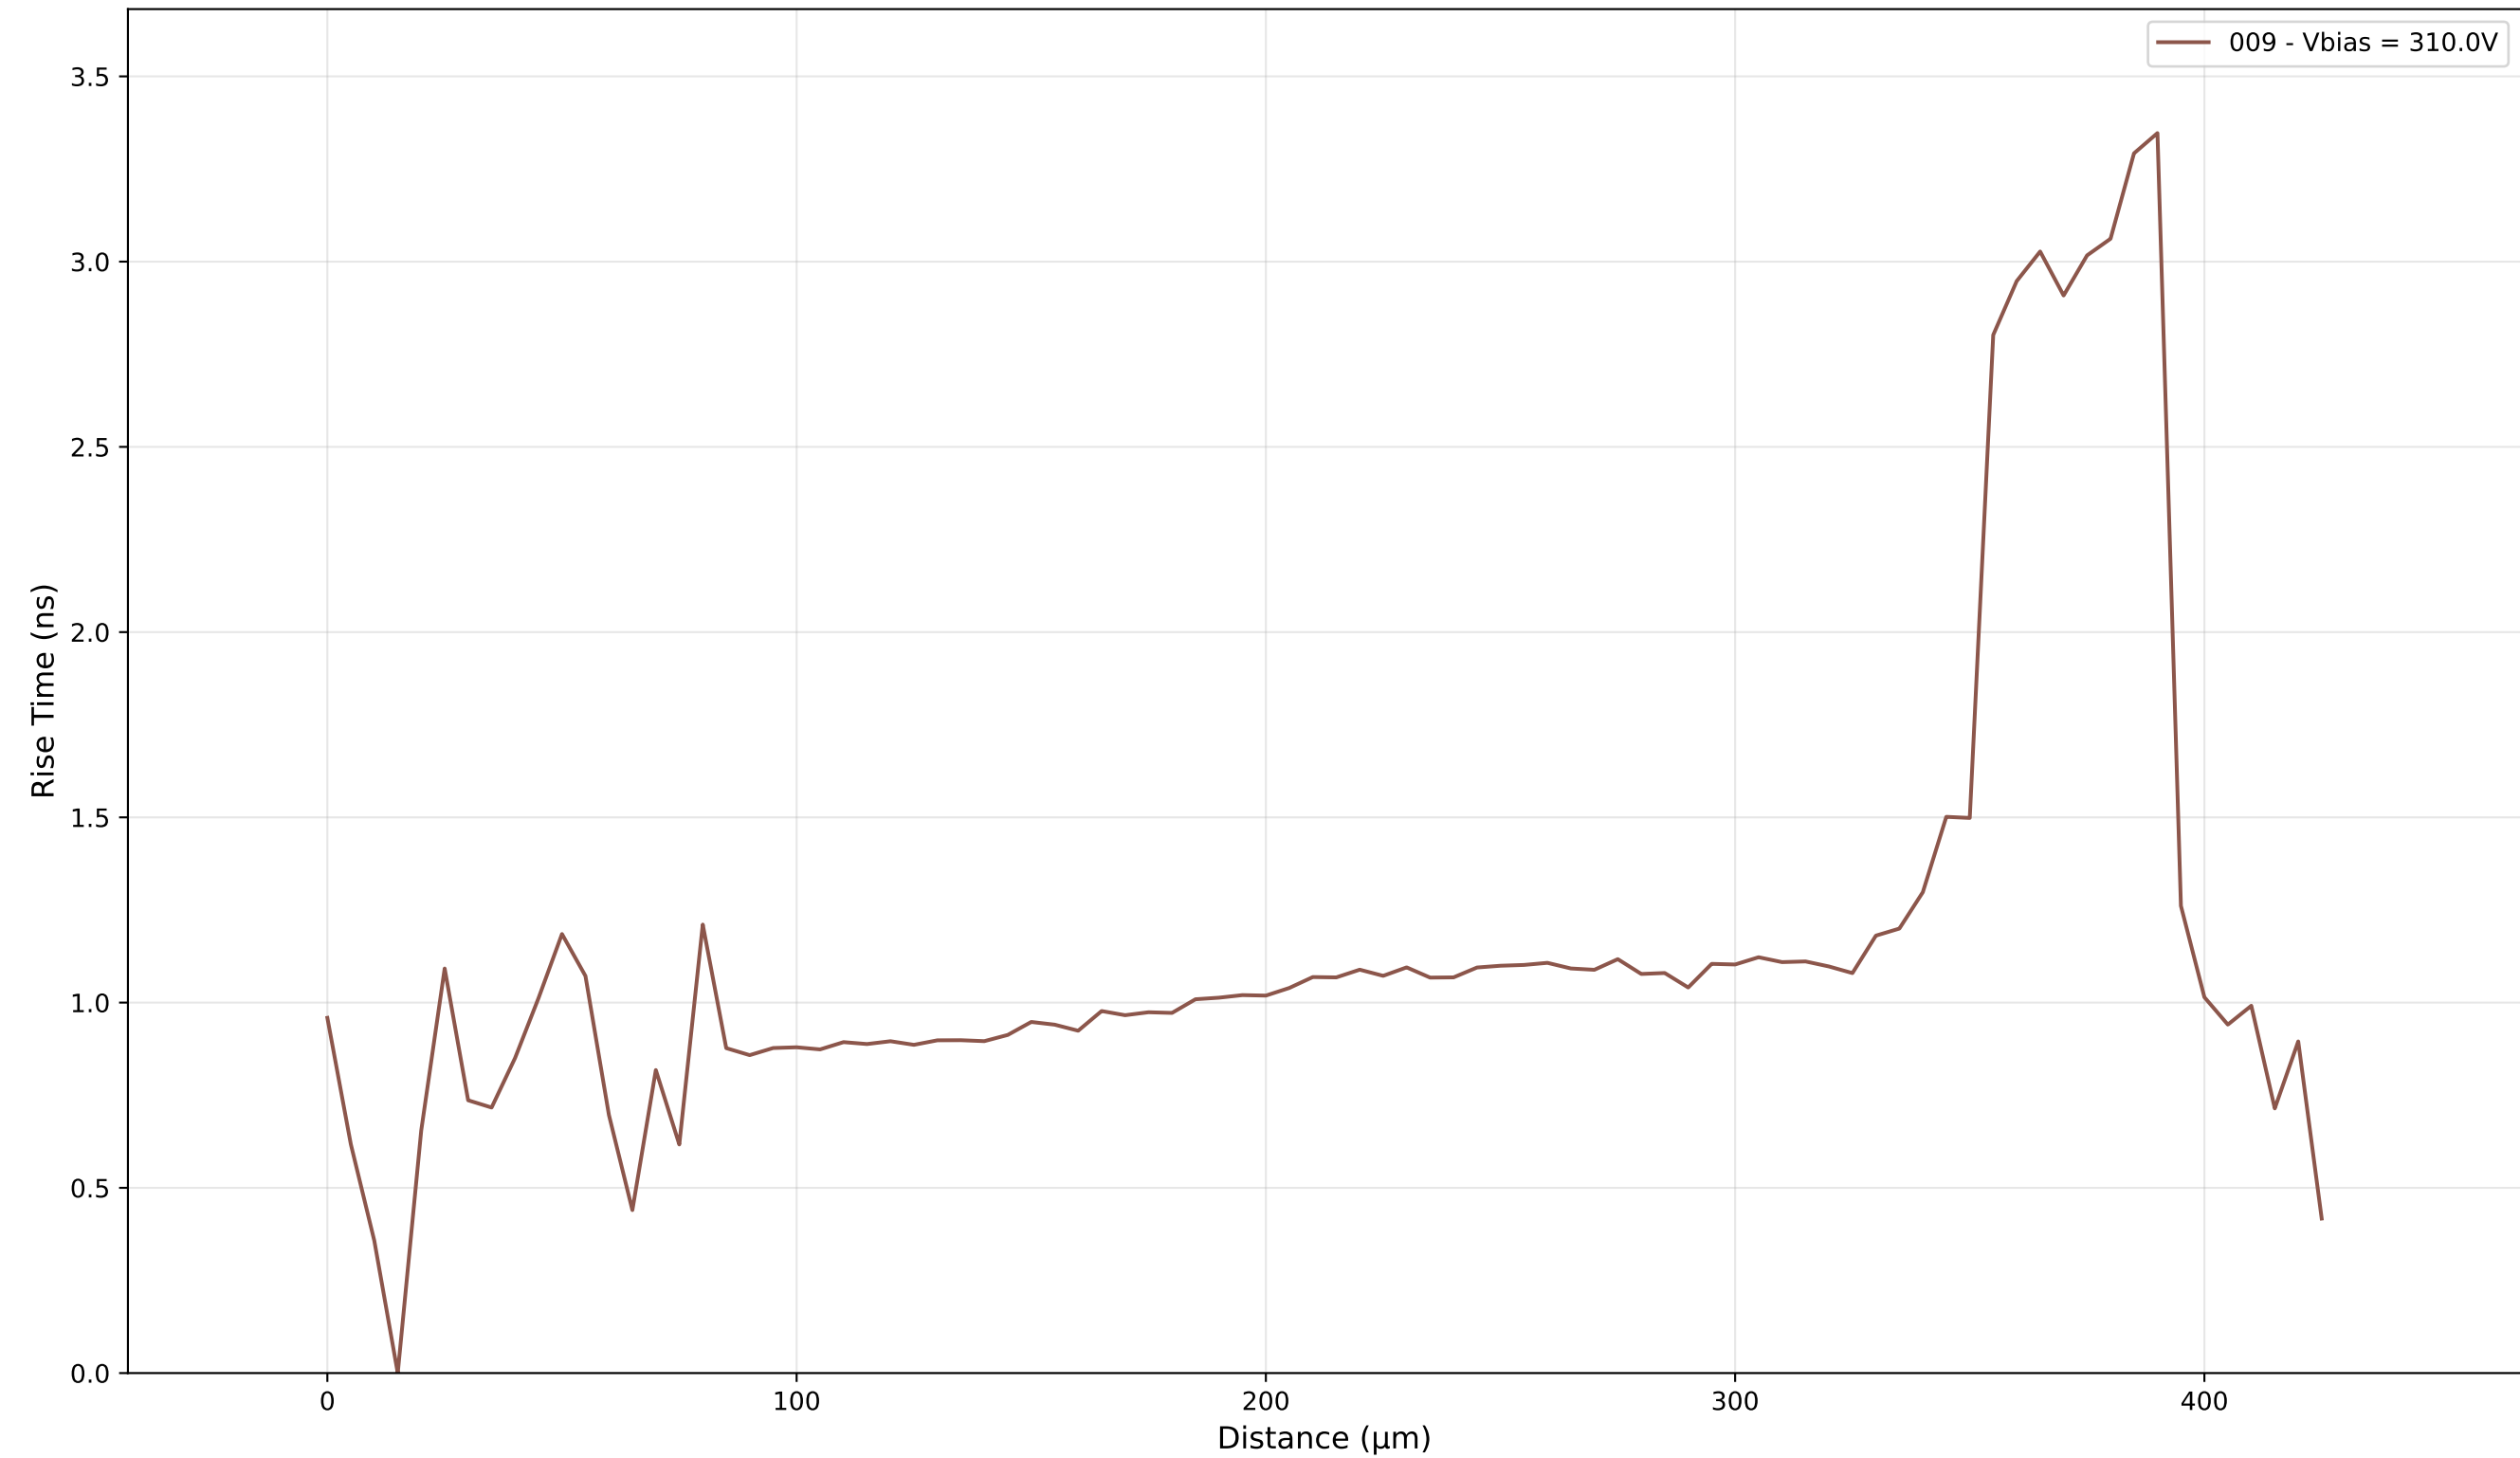


Amplitude

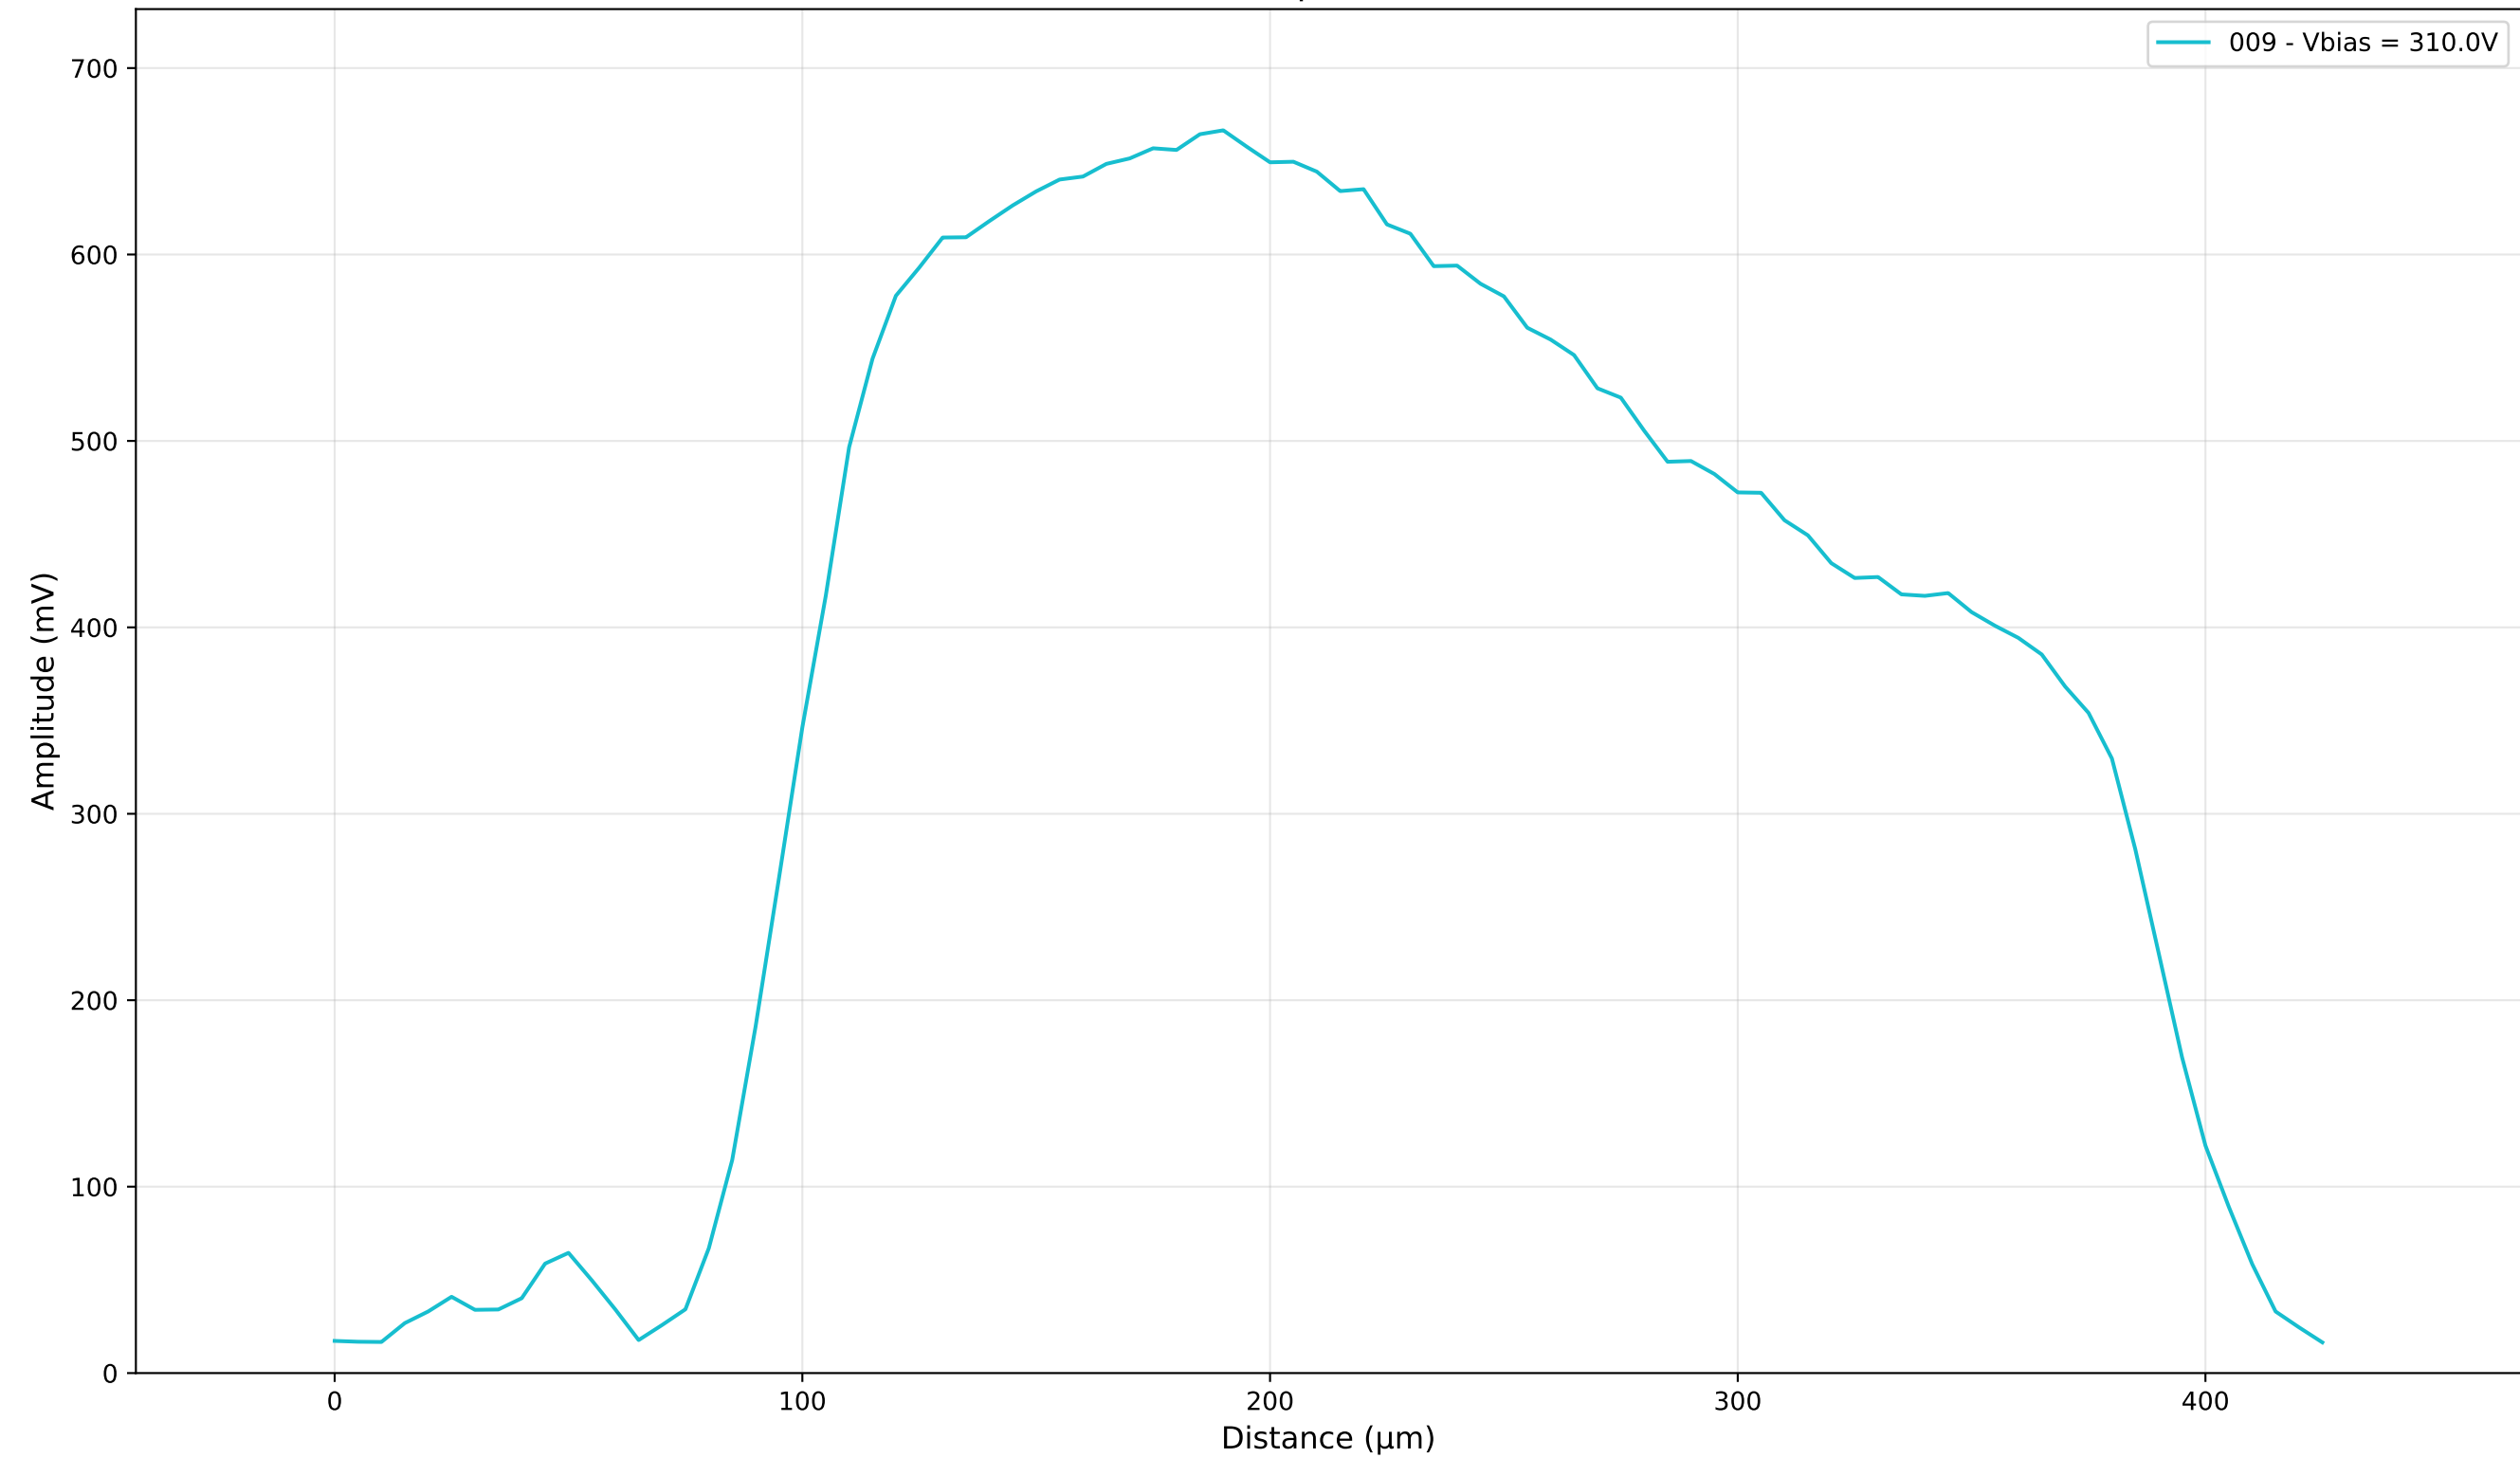


FWHM

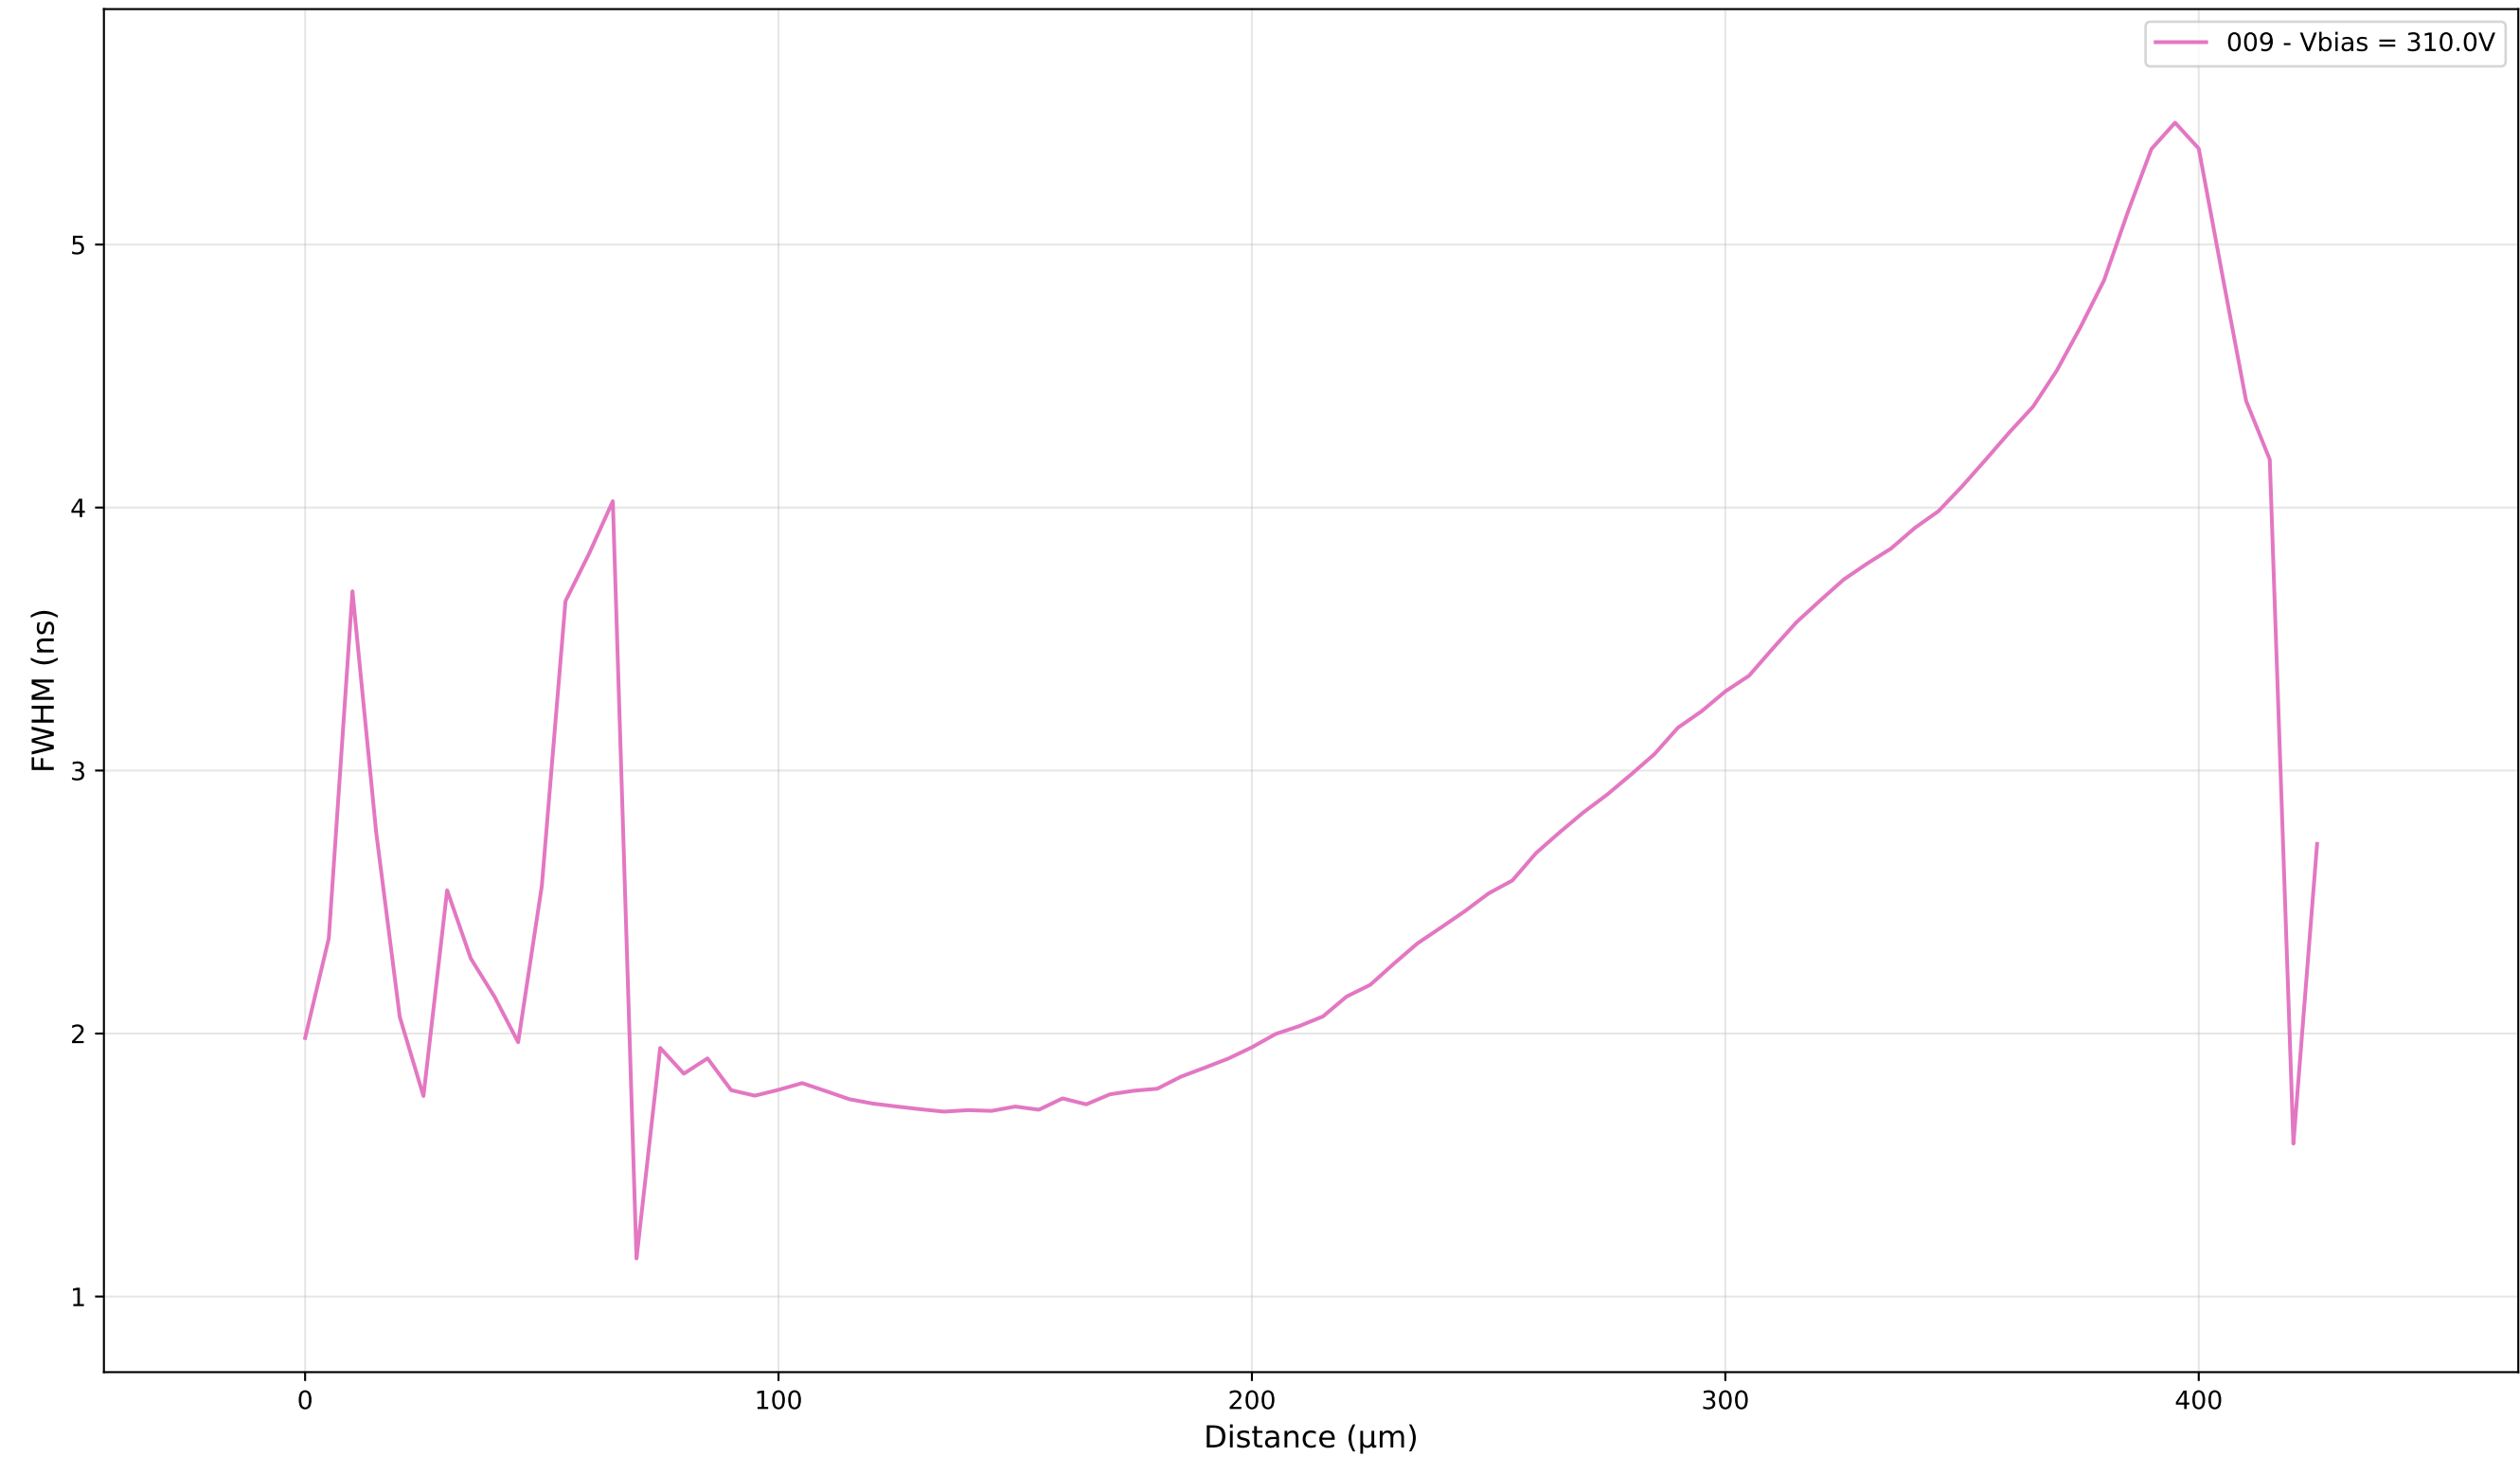


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.34 pC - Rise Time: 0.96 ns

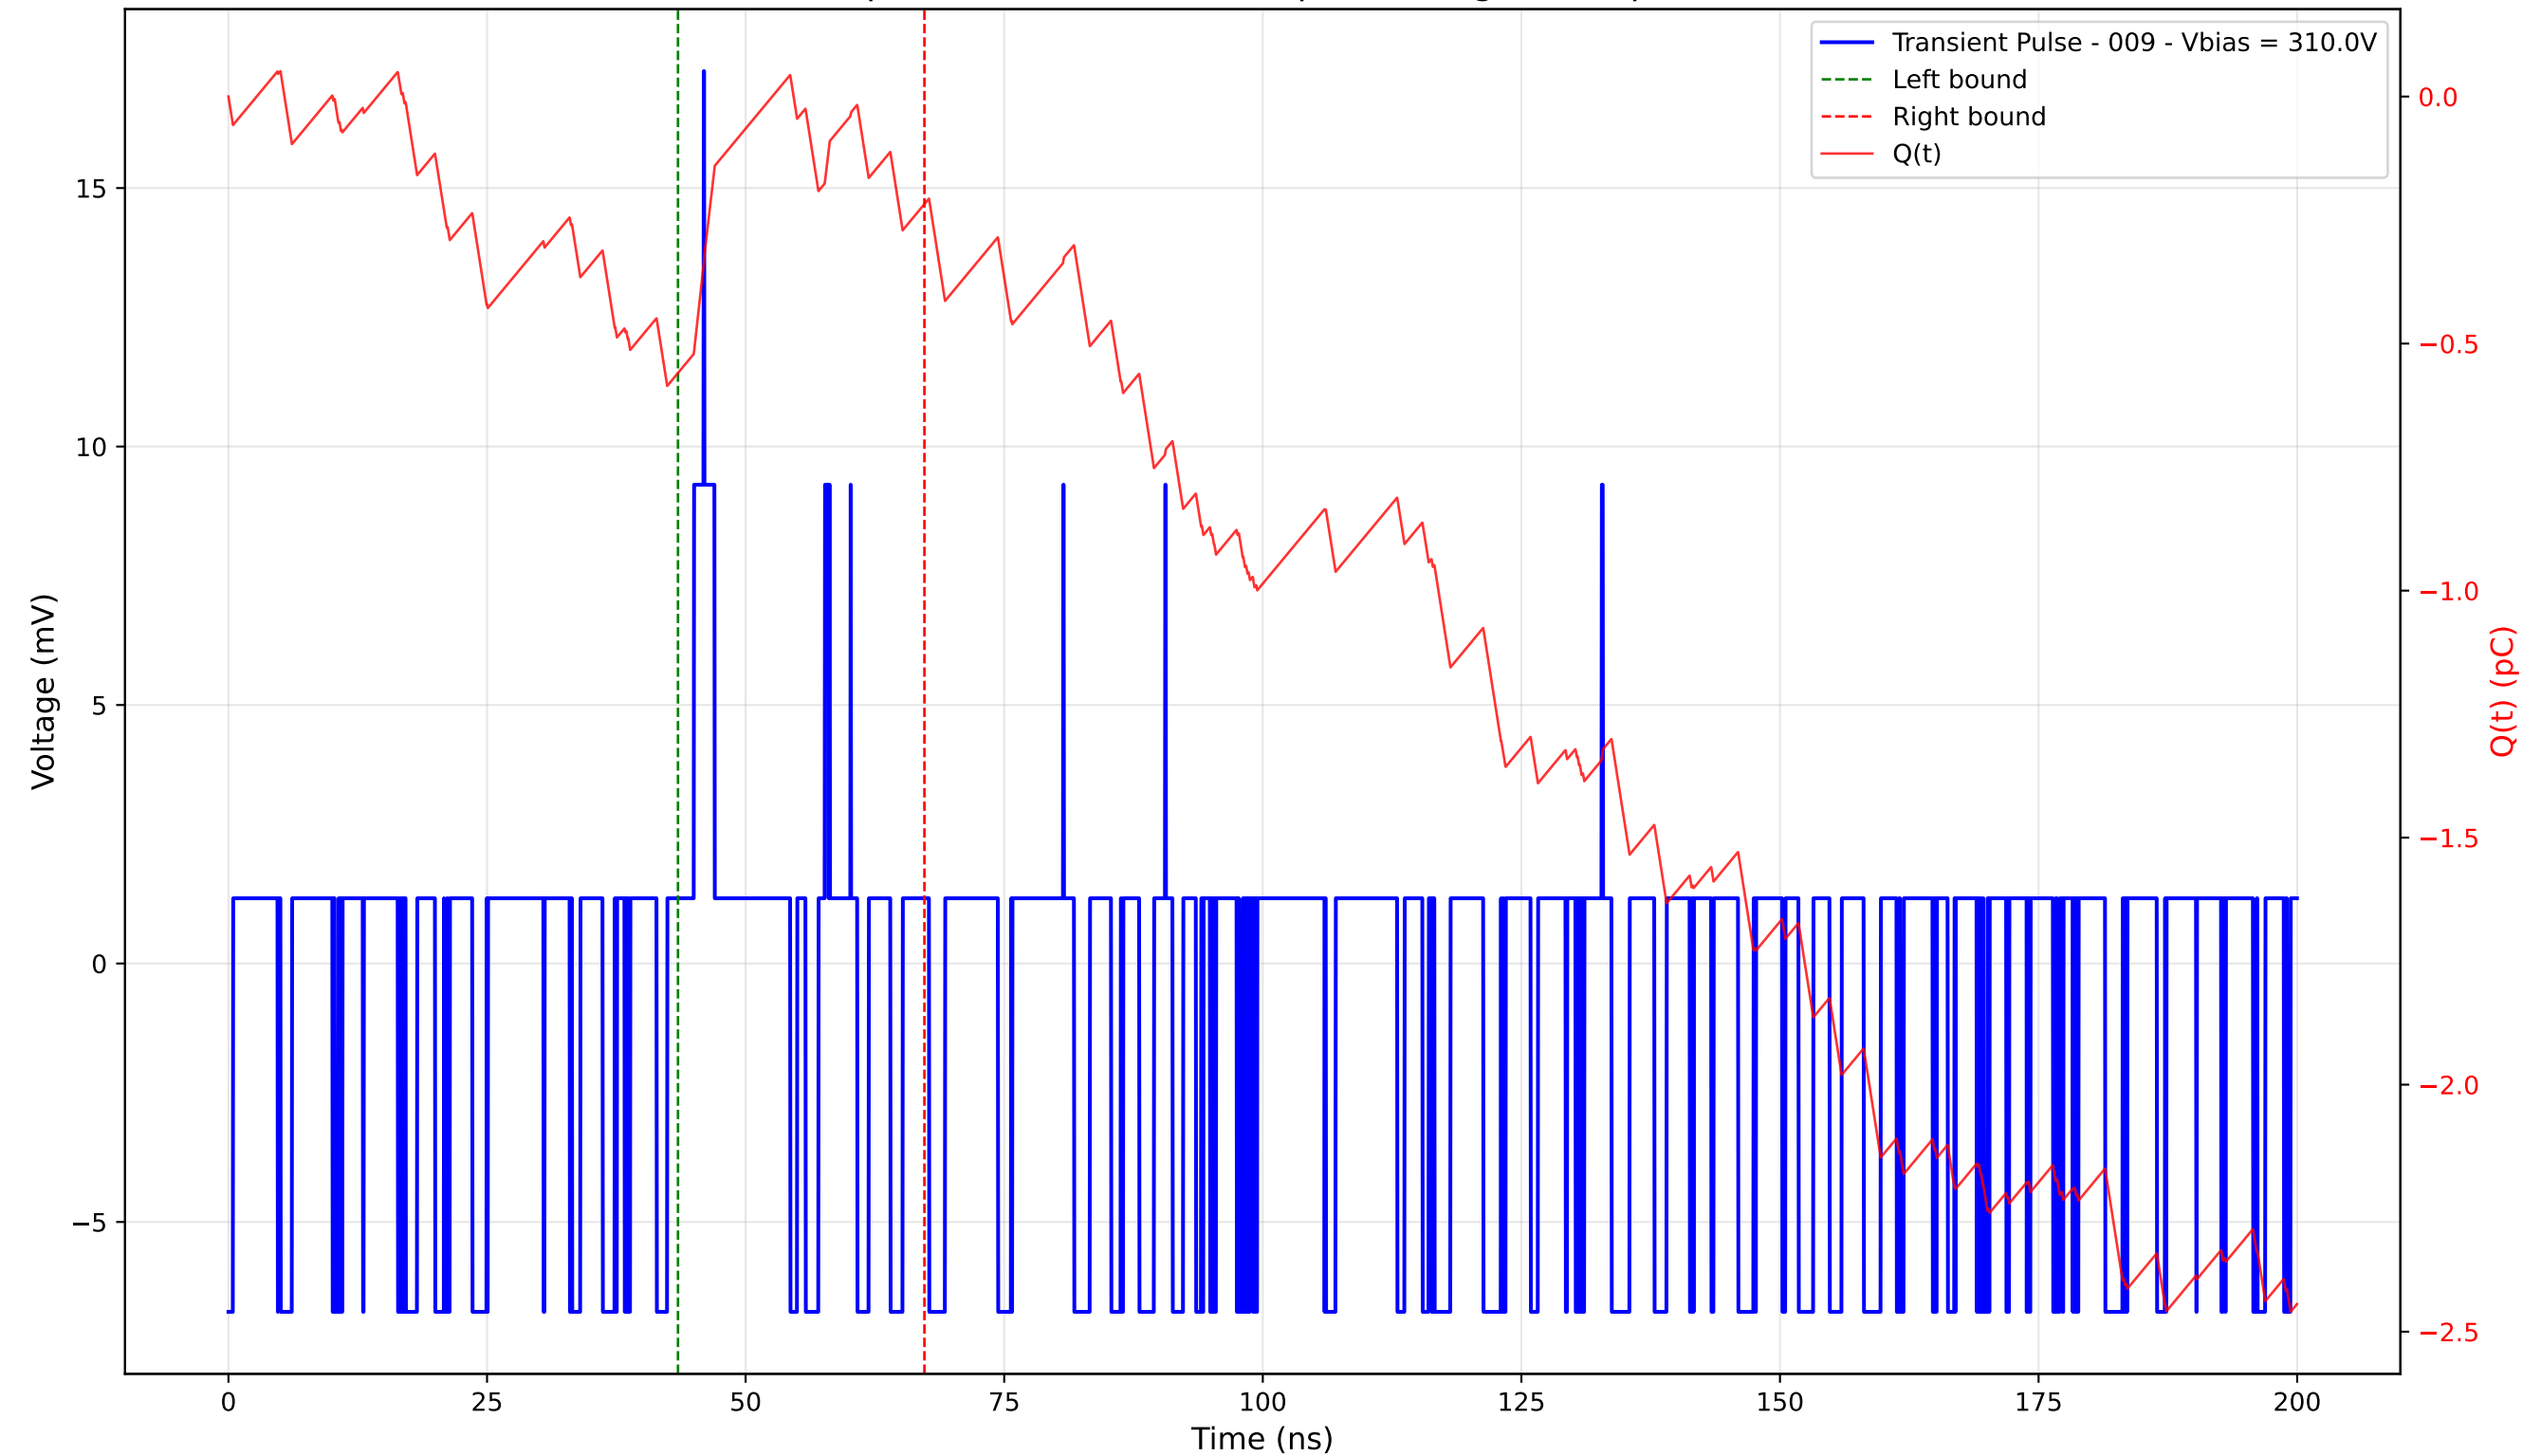


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.73 pC - Rise Time: 0.62 ns

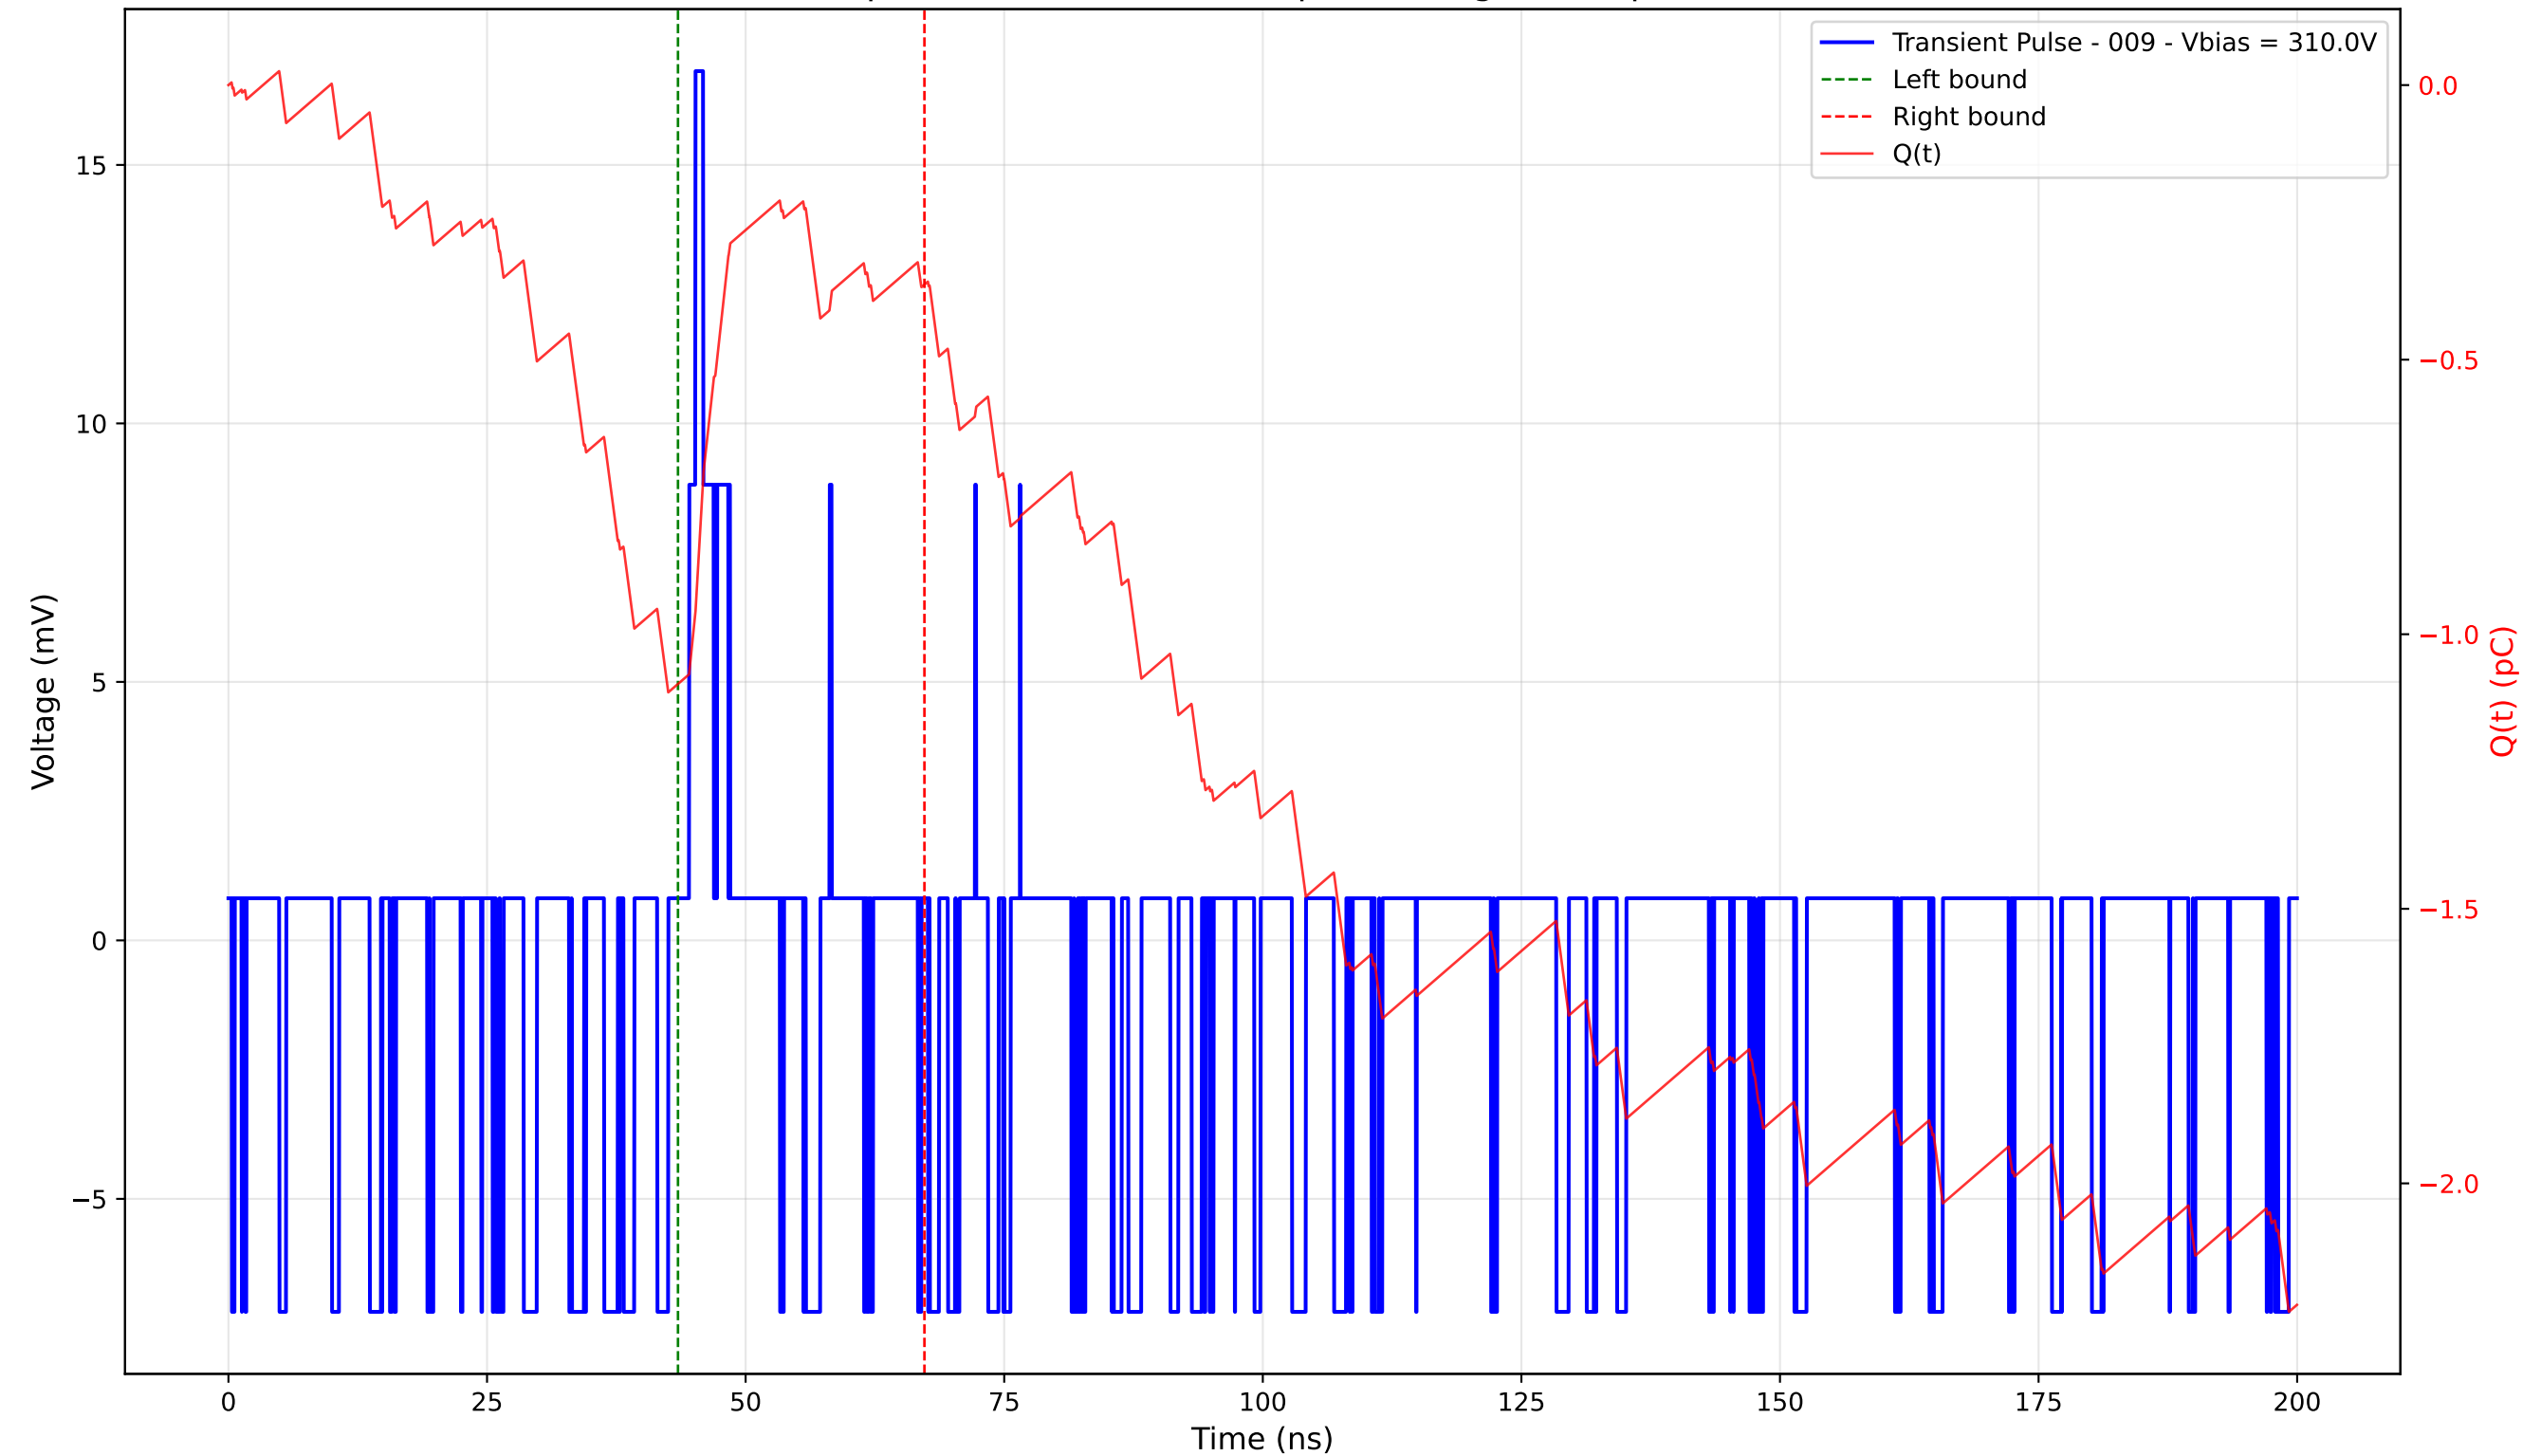


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.42 pC - Rise Time: 0.36 ns

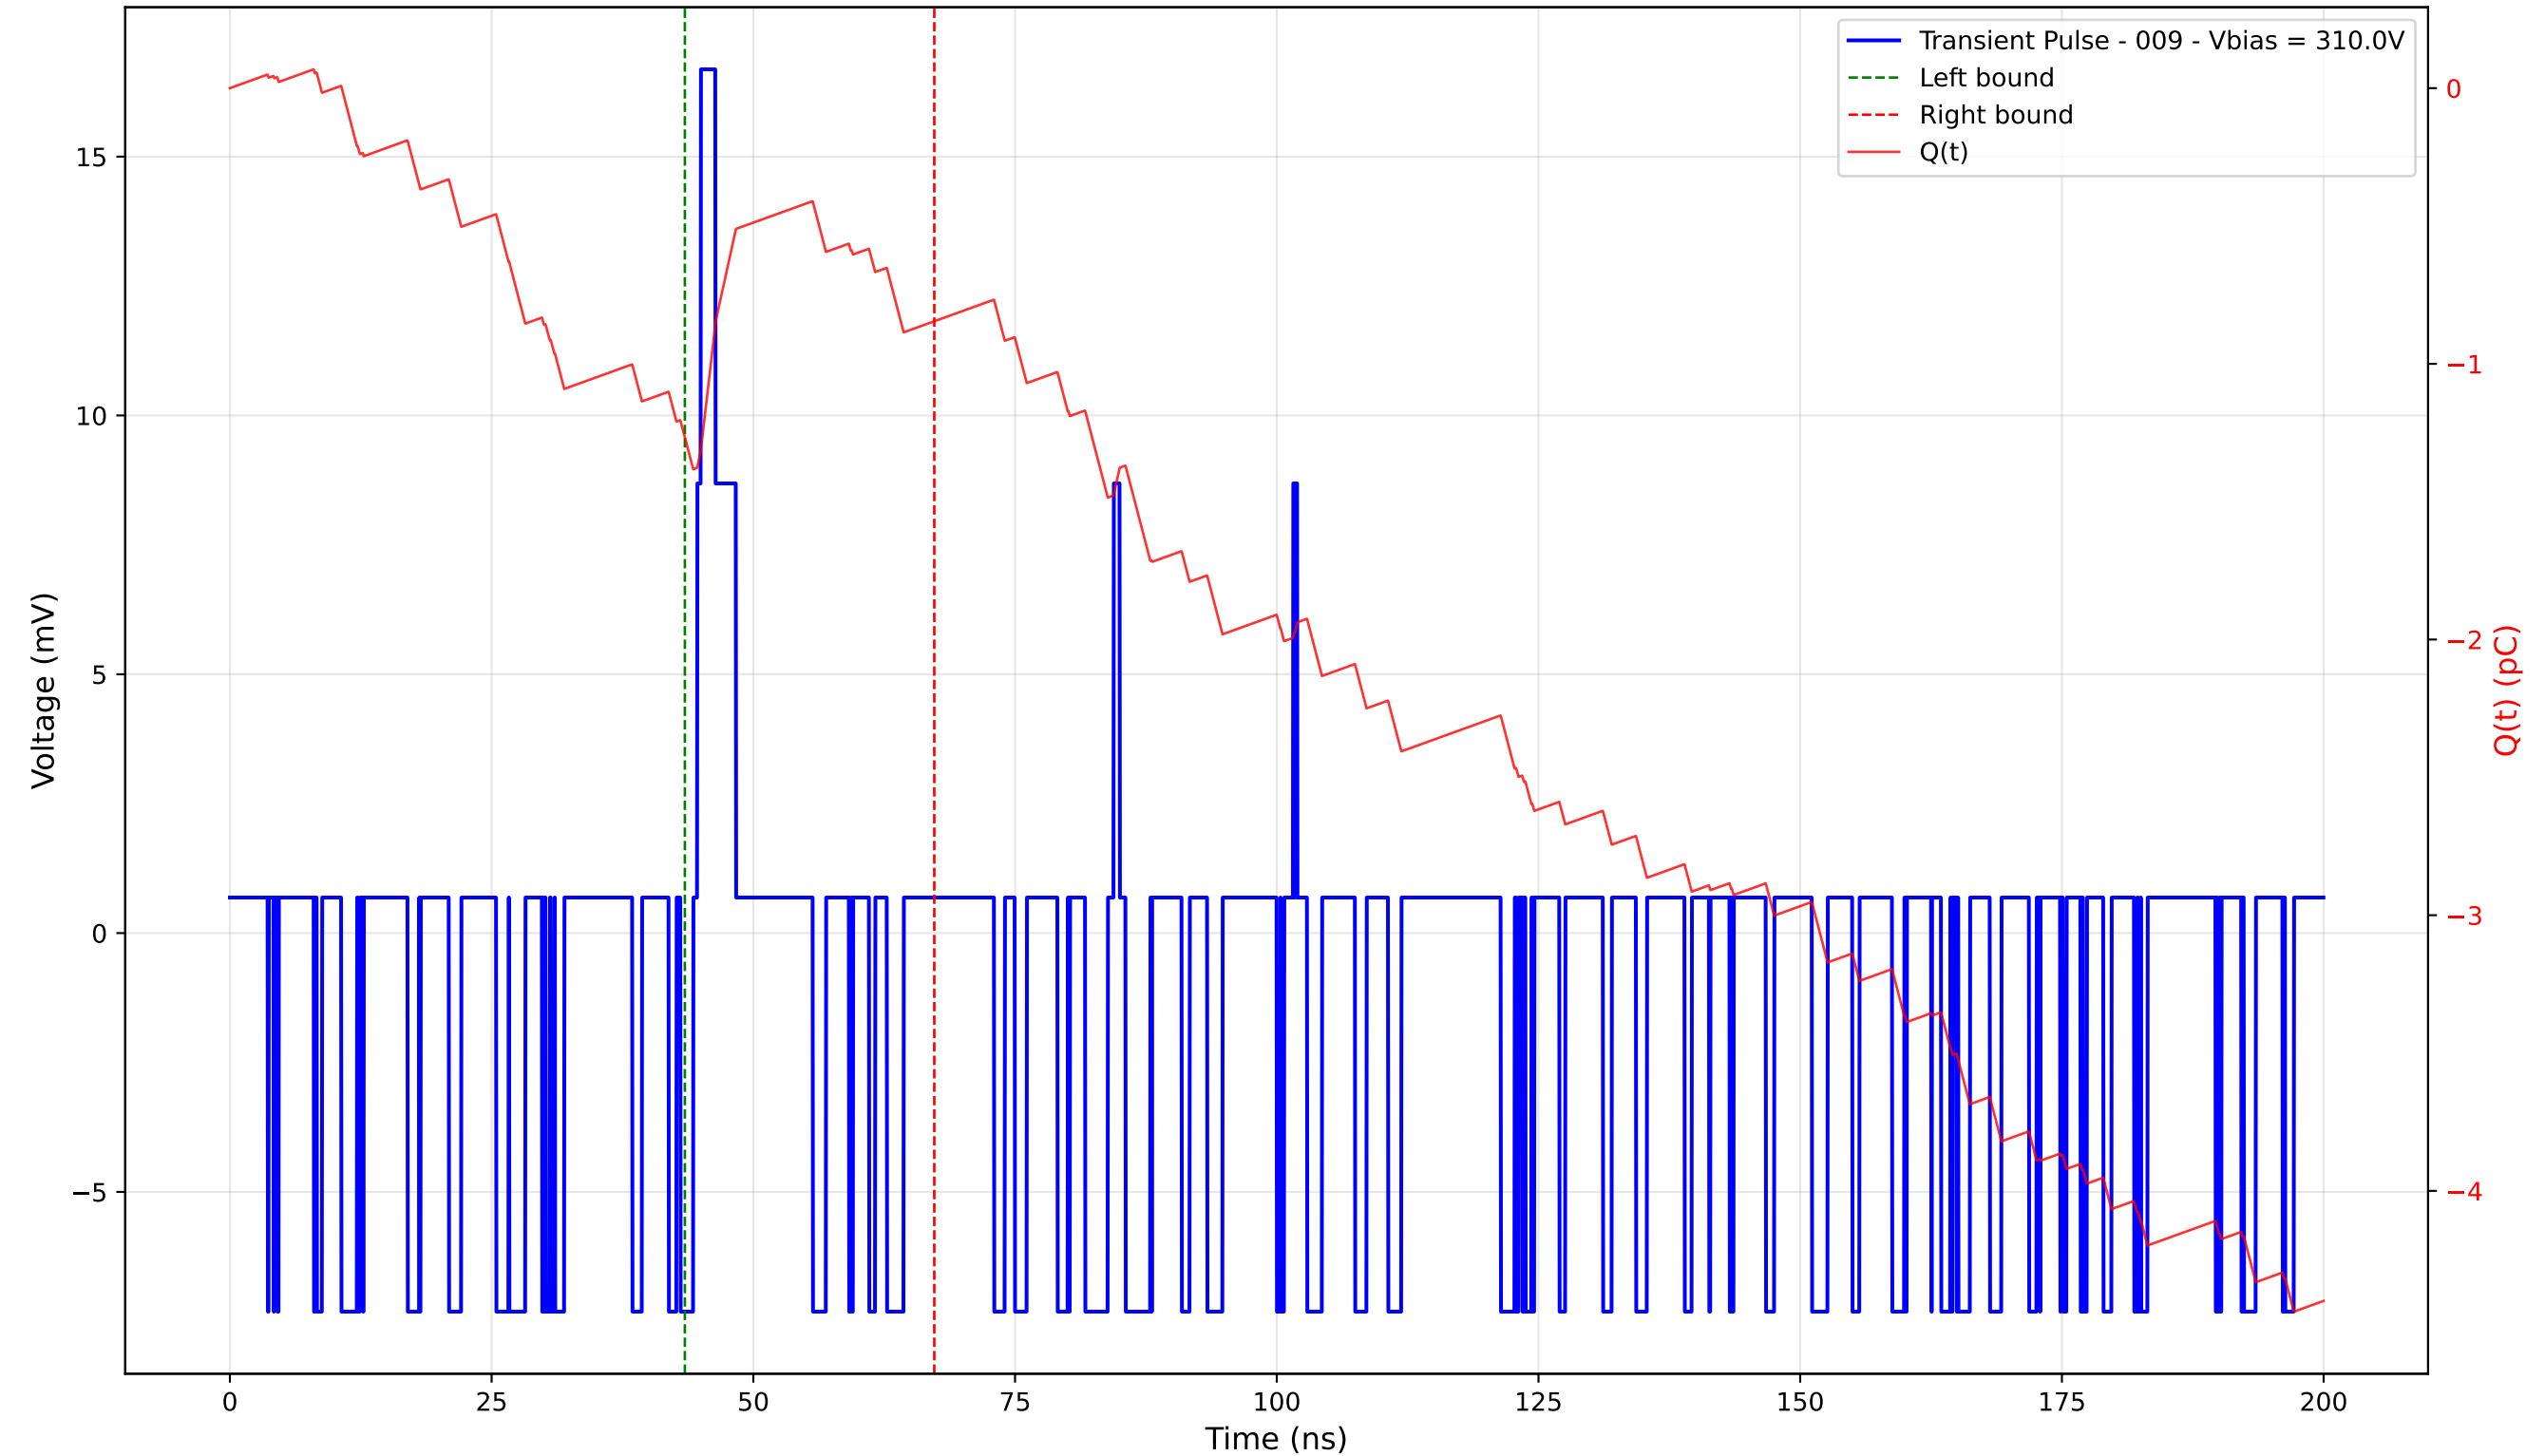


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.39 pC - Rise Time: 0.00 ns (N/A)

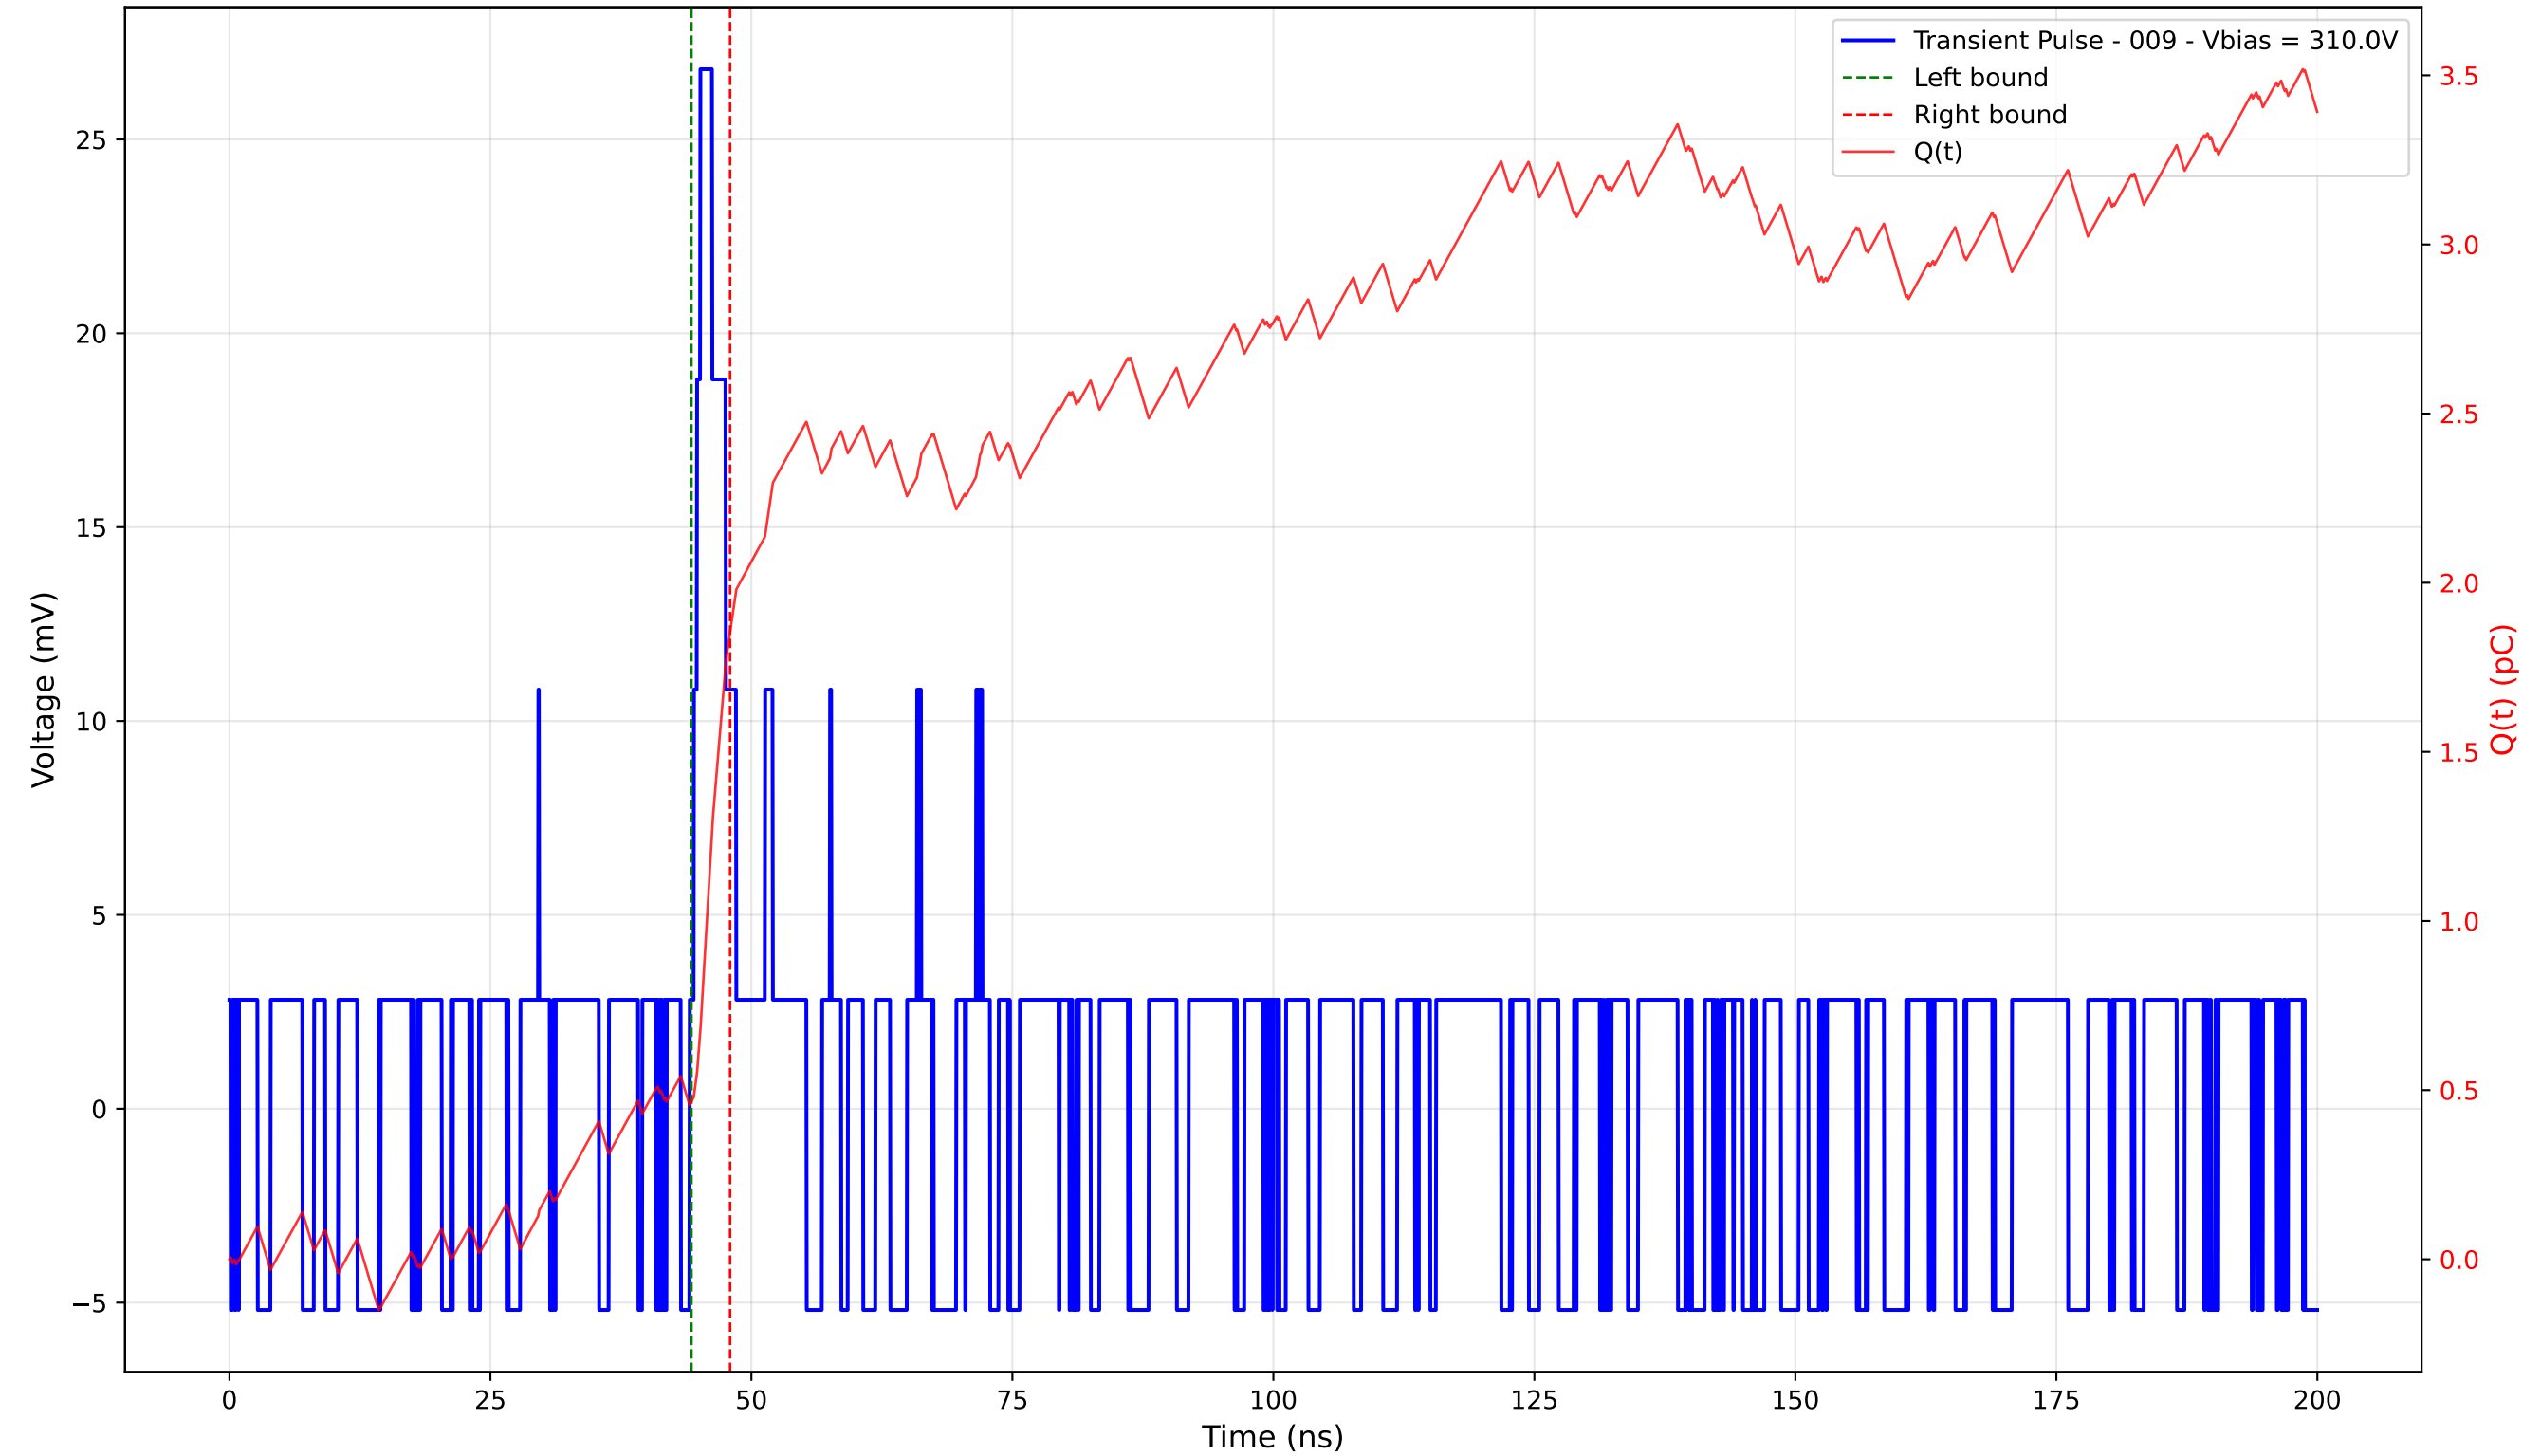


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.46 pC - Rise Time: 0.65 ns

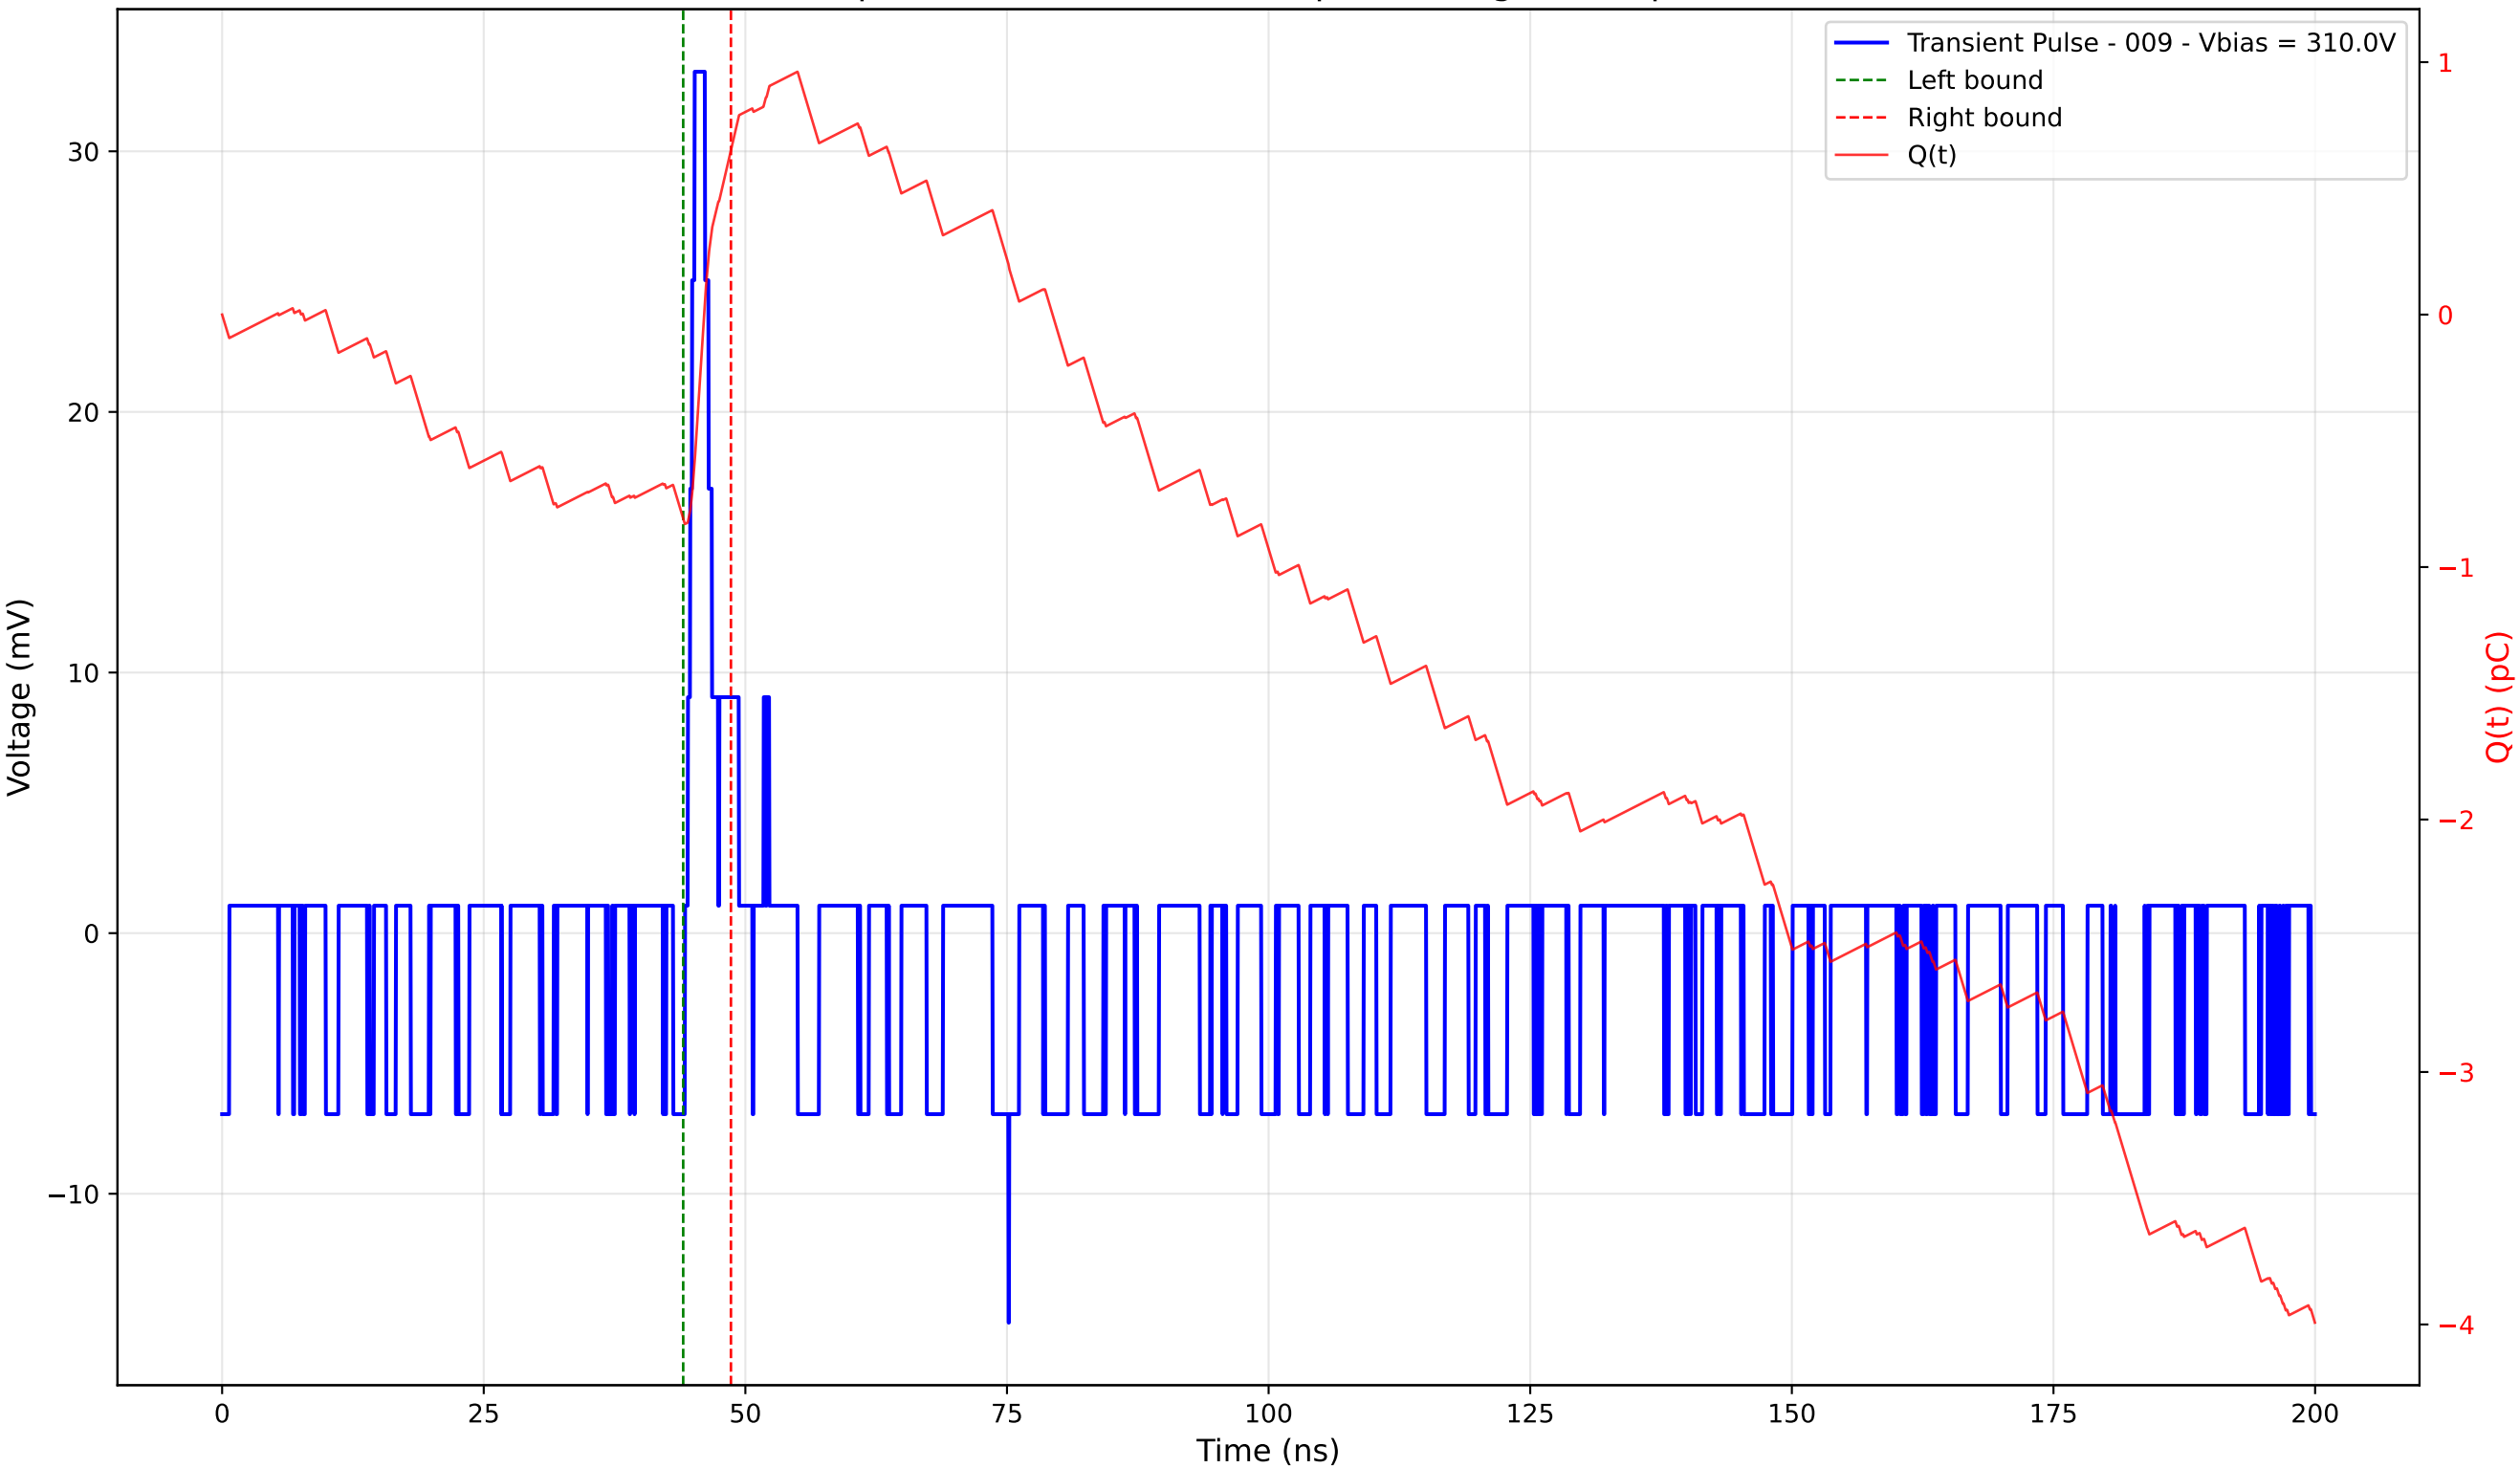


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.97 pC - Rise Time: 1.09 ns

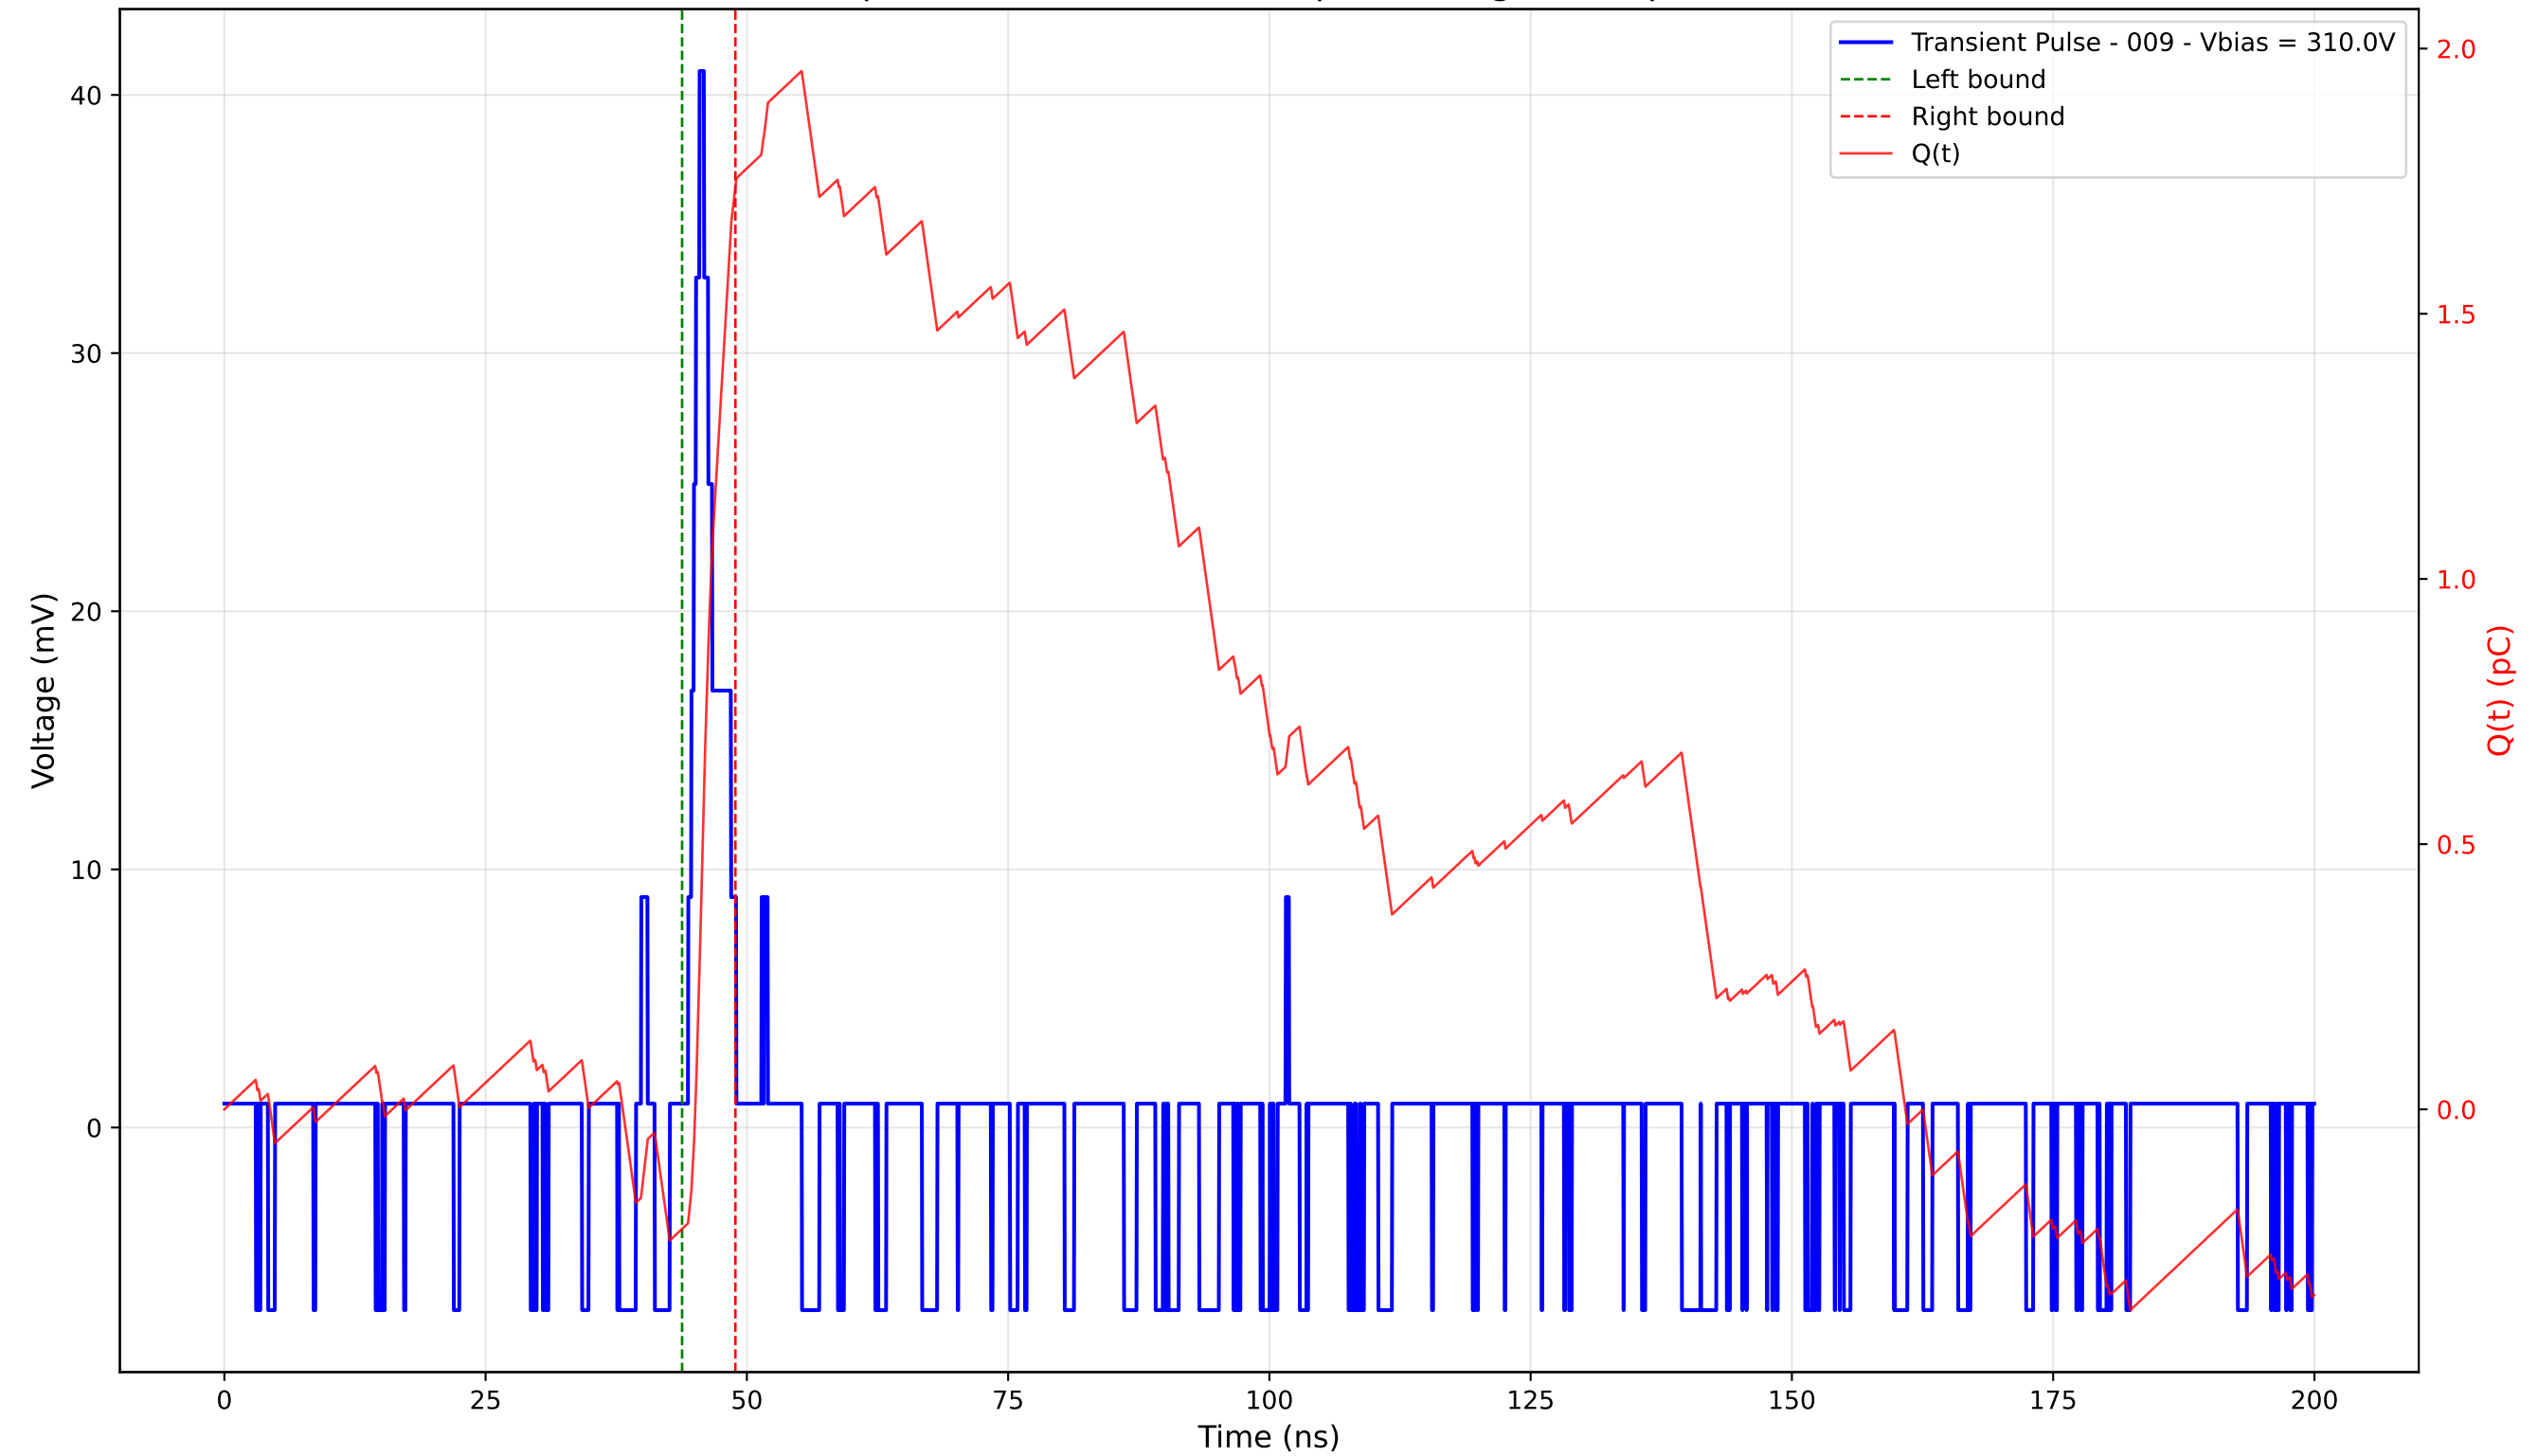


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.68 pC - Rise Time: 0.74 ns

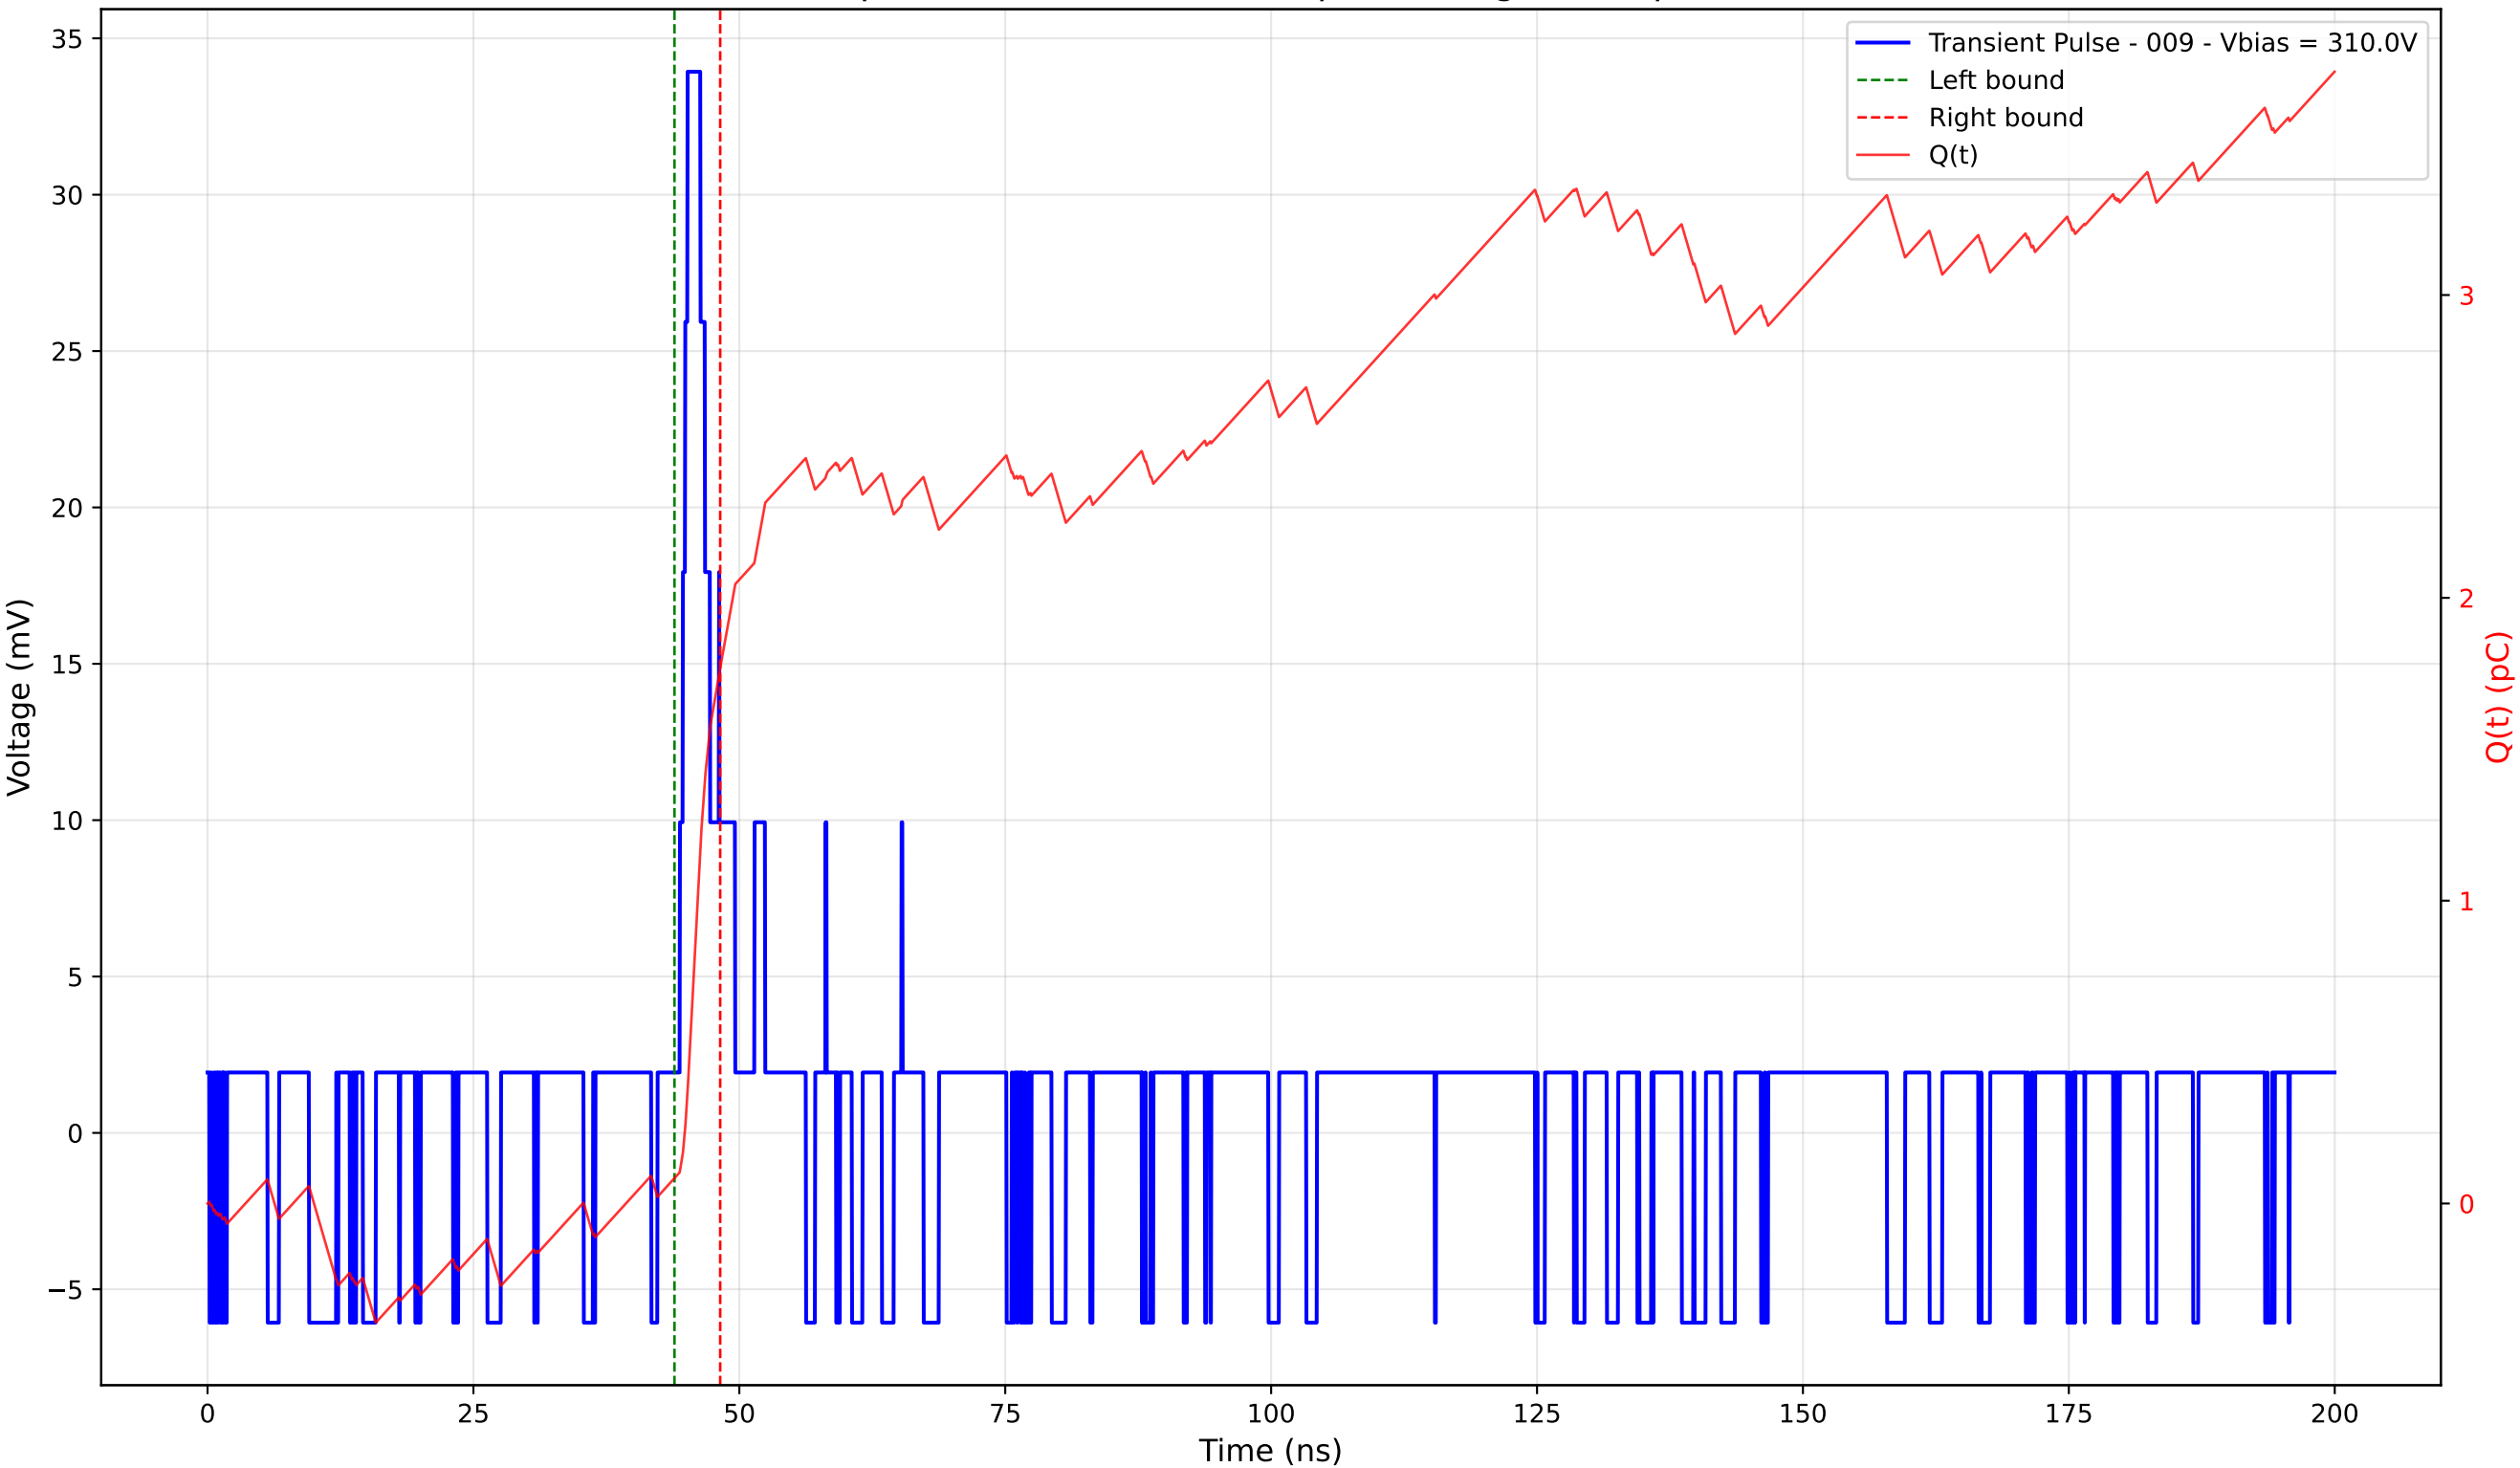


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.47 pC - Rise Time: 0.72 ns

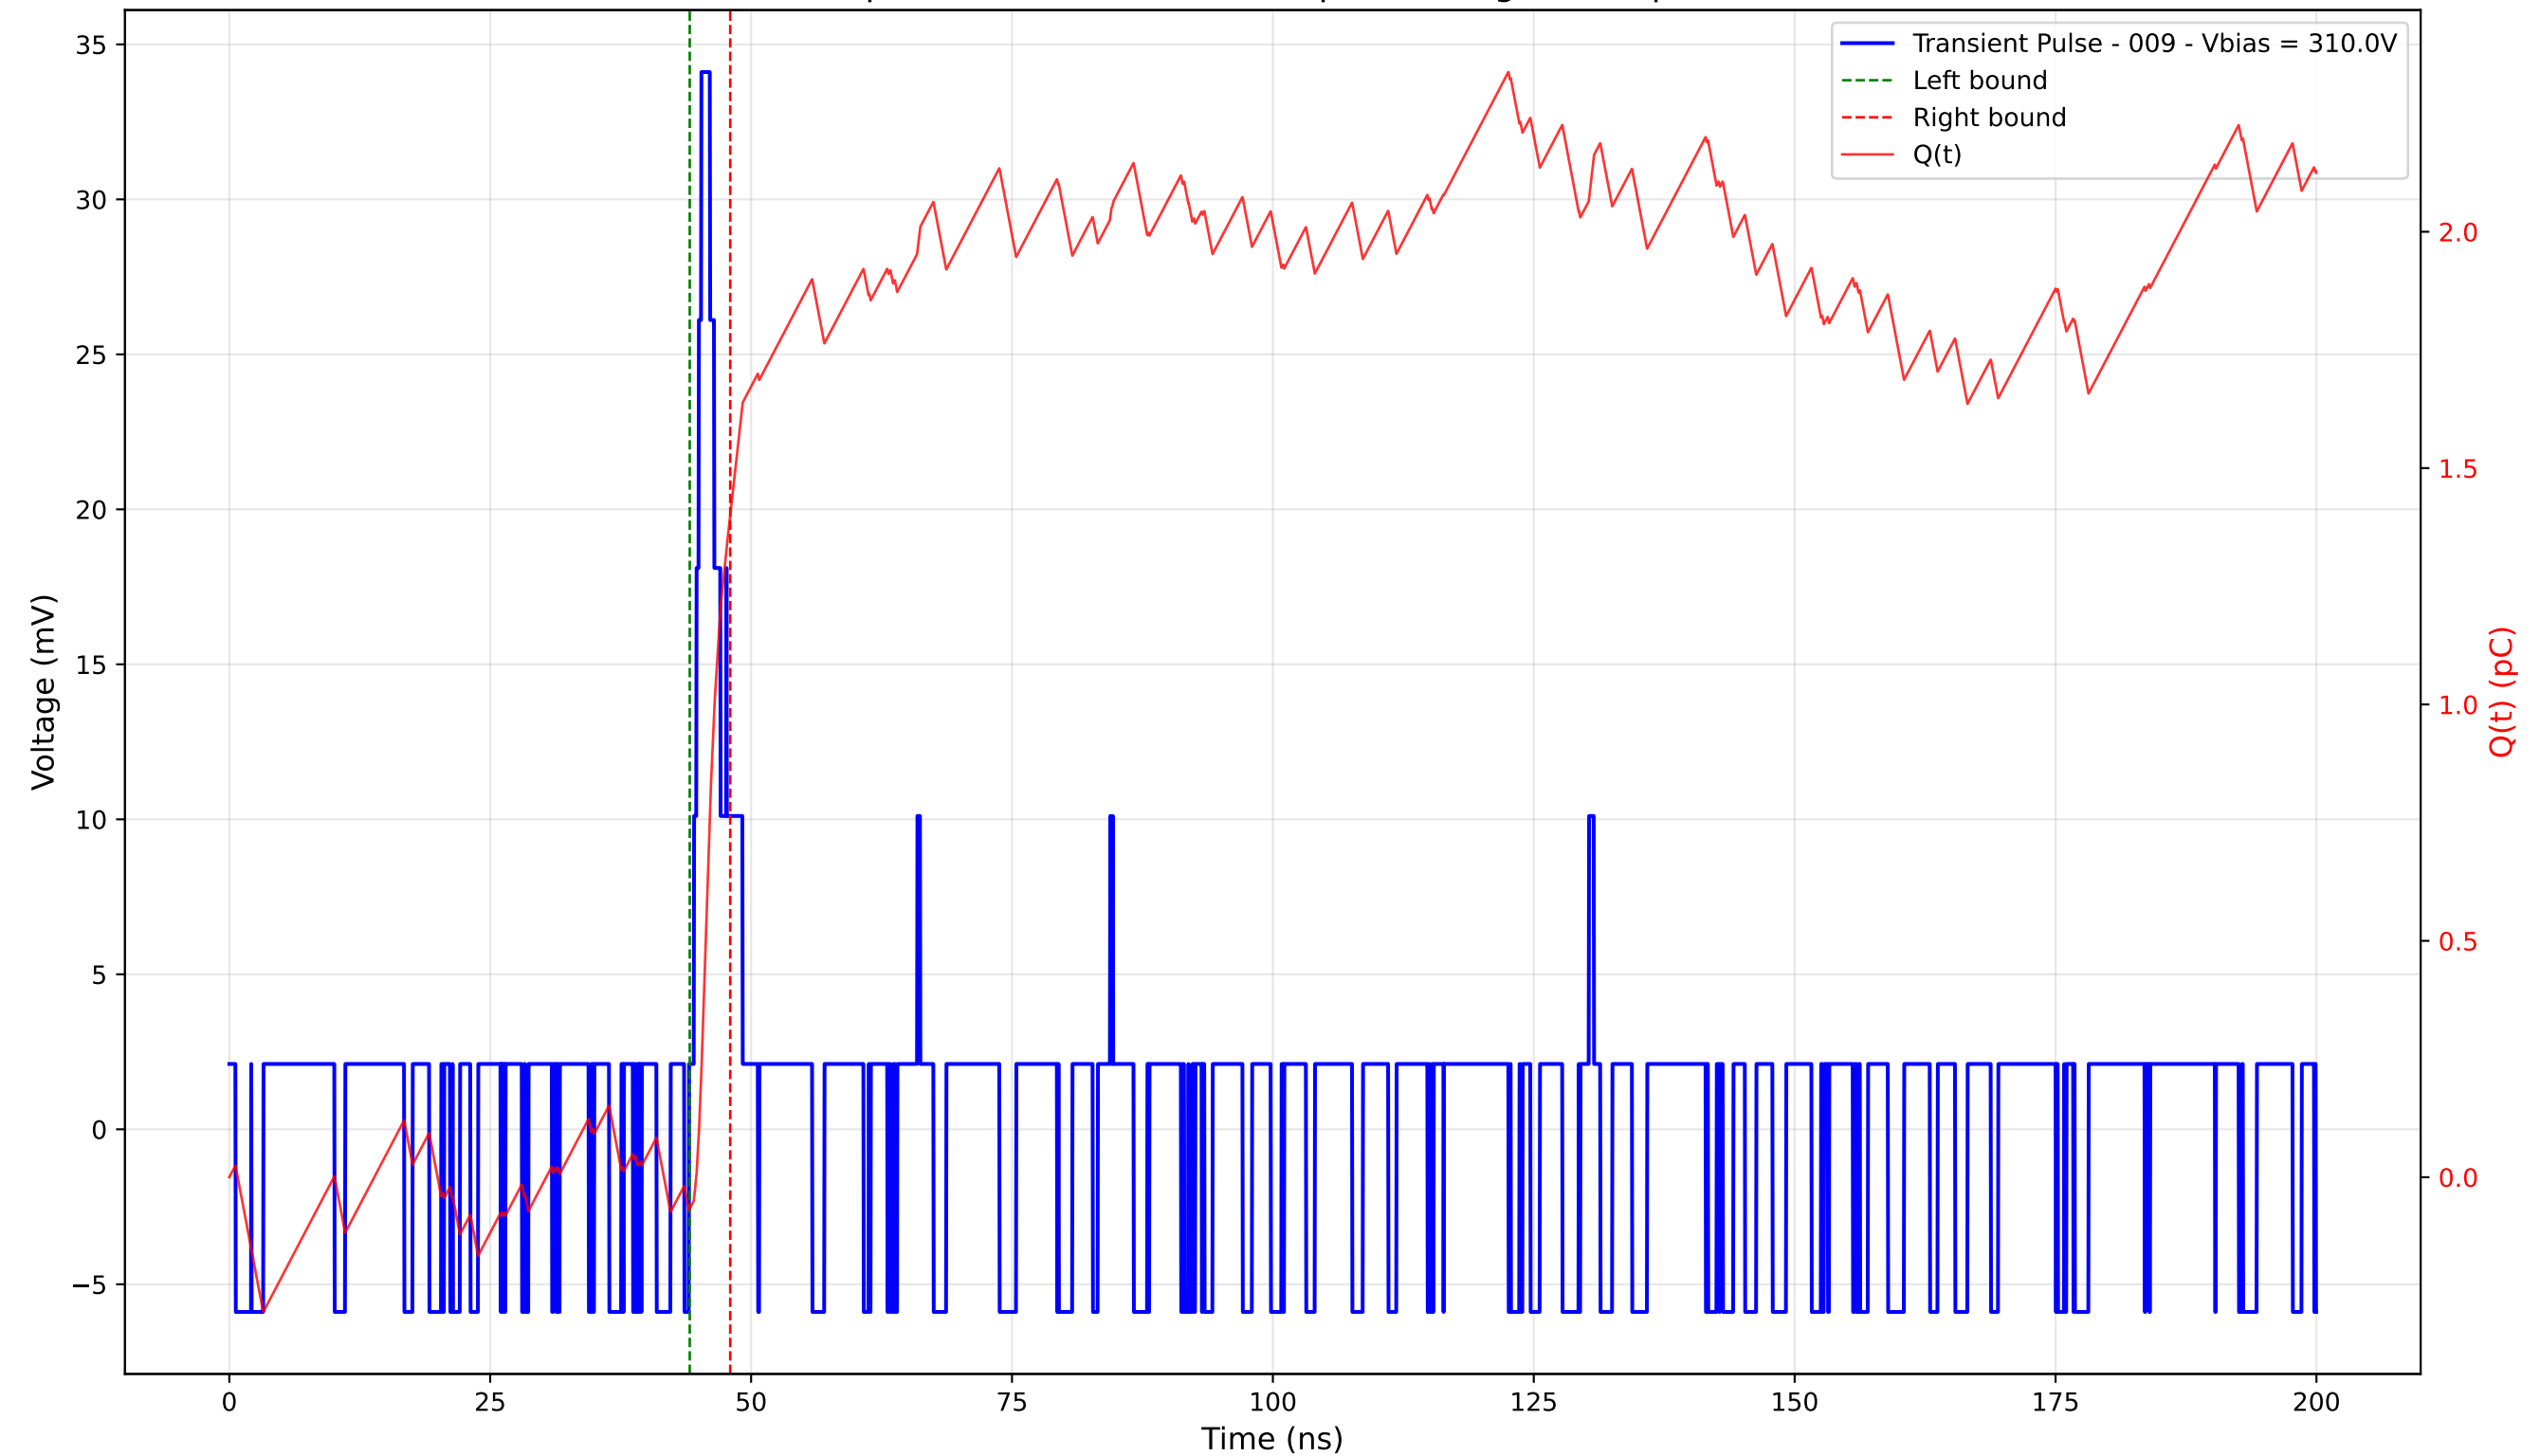


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.00 pC - Rise Time: 0.85 ns

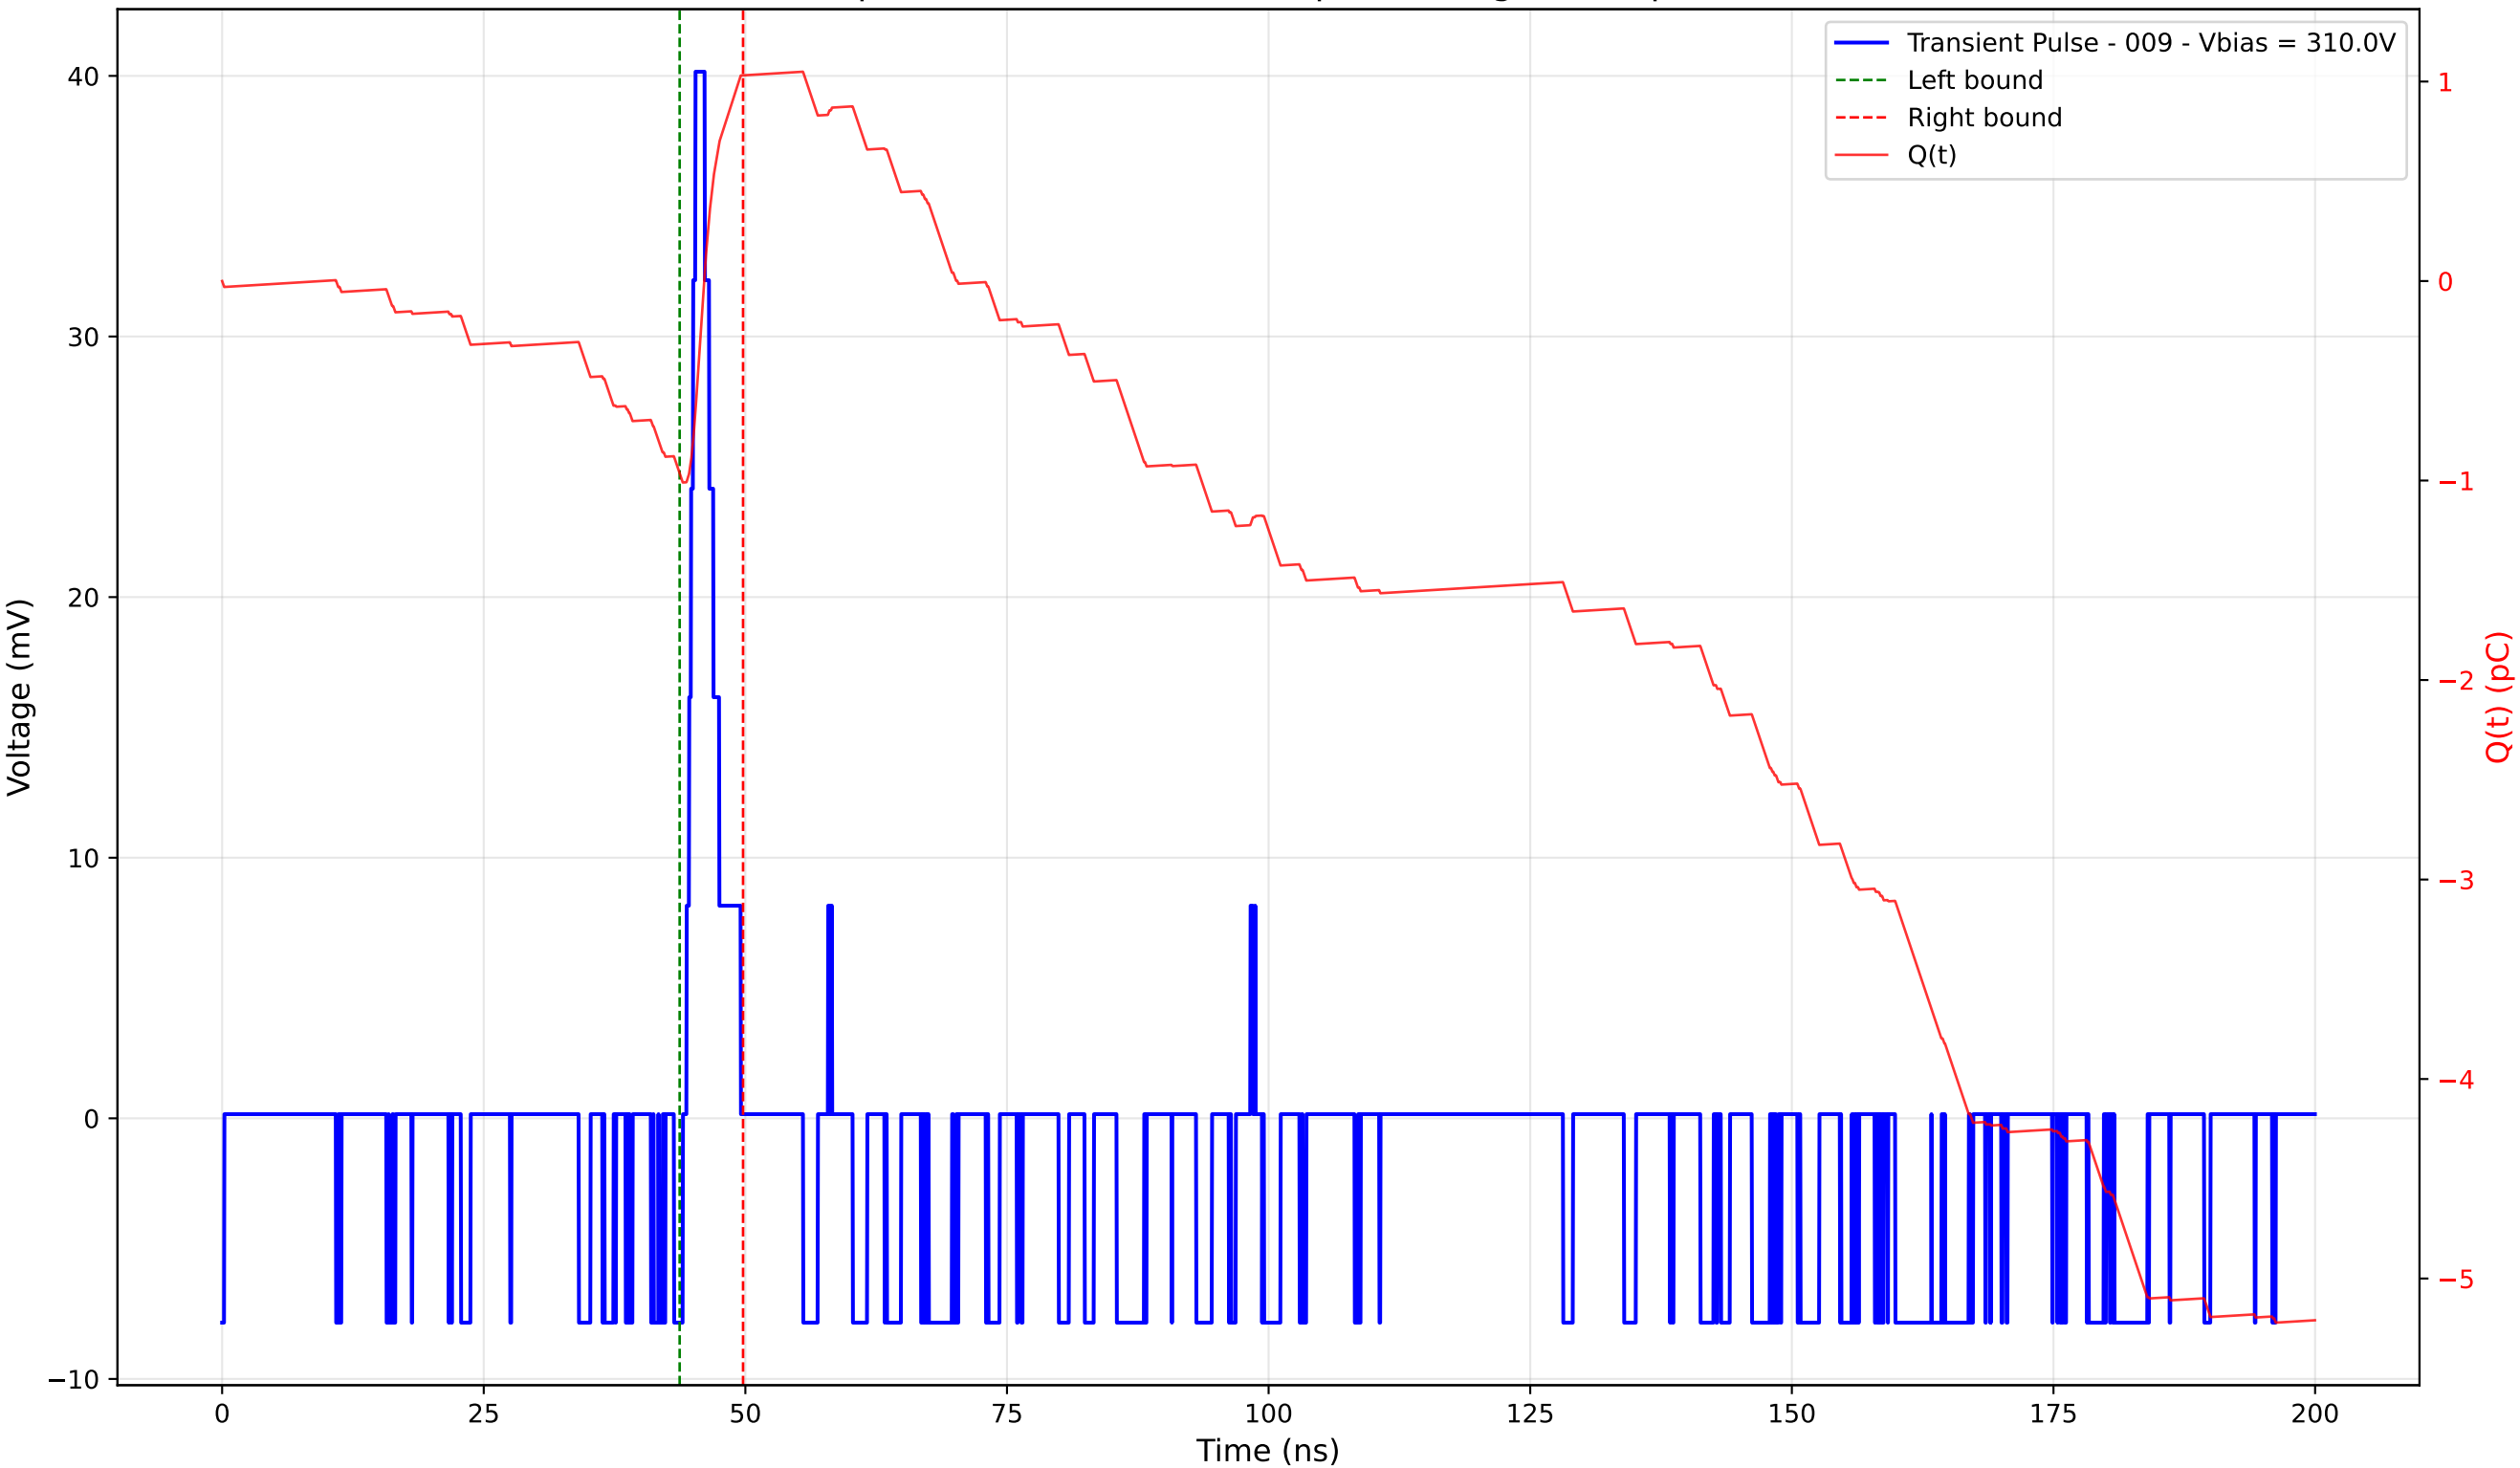


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.94 pC - Rise Time: 1.01 ns

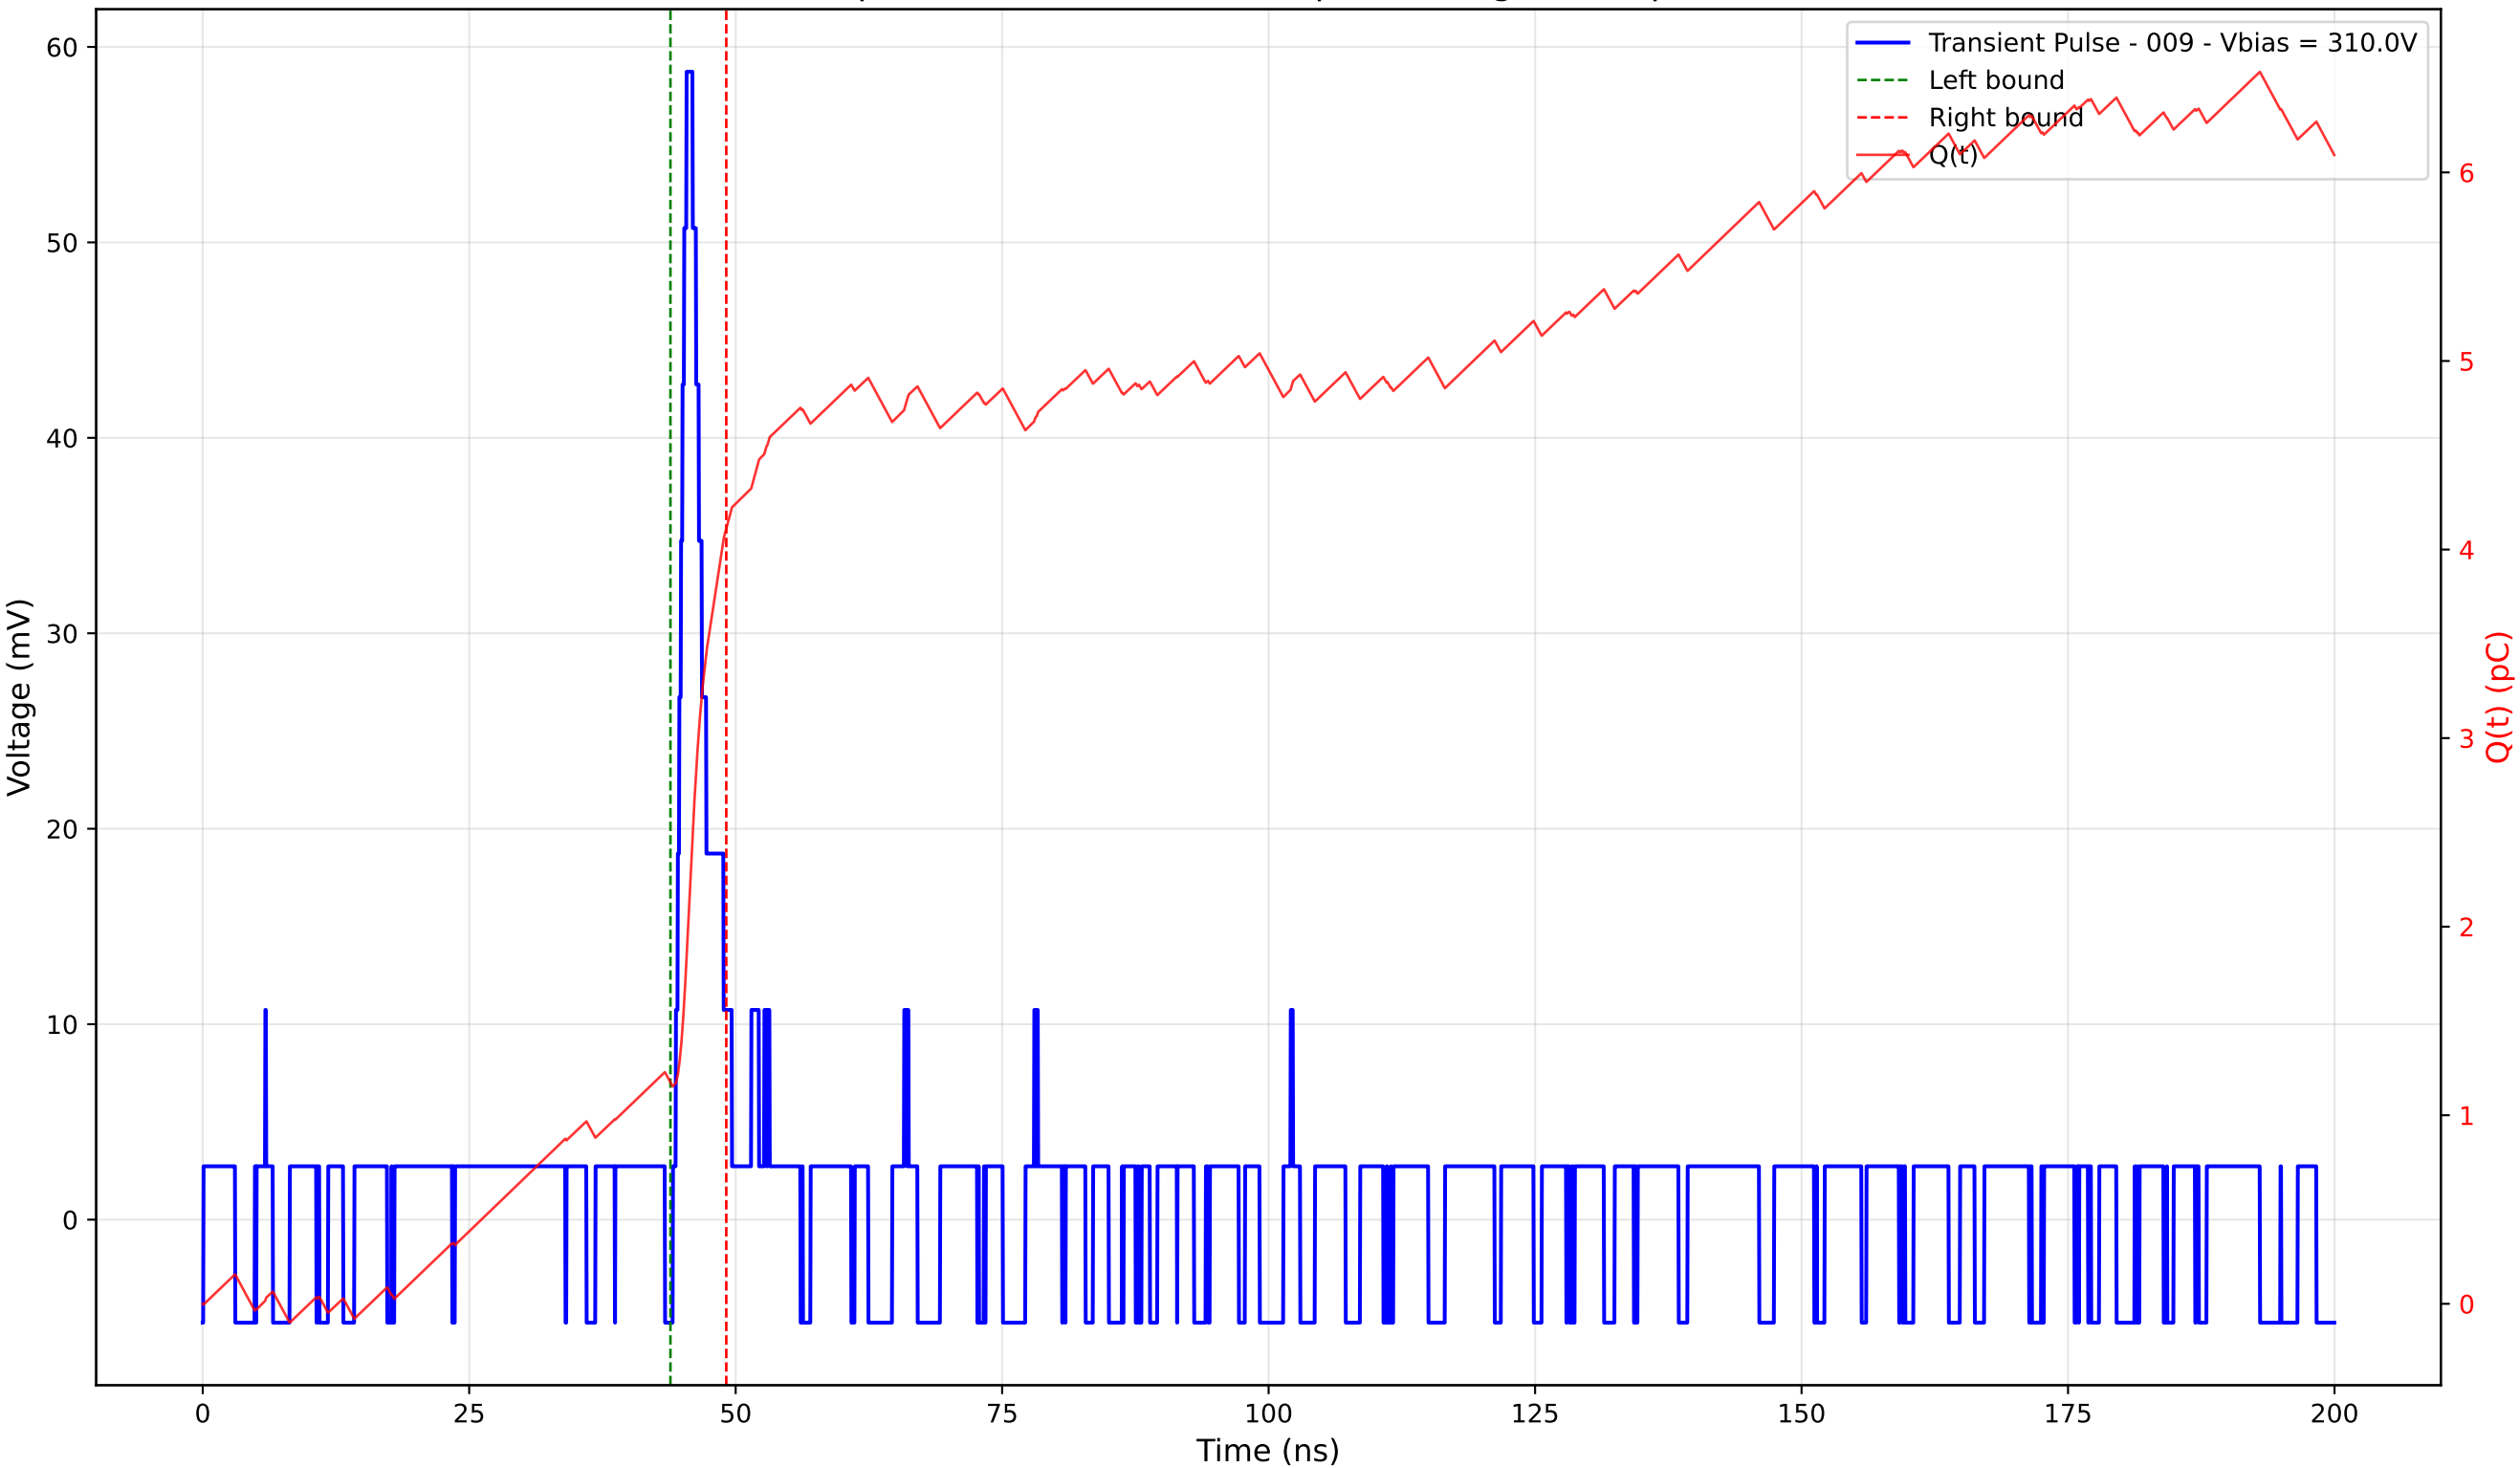


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.37 pC - Rise Time: 1.19 ns

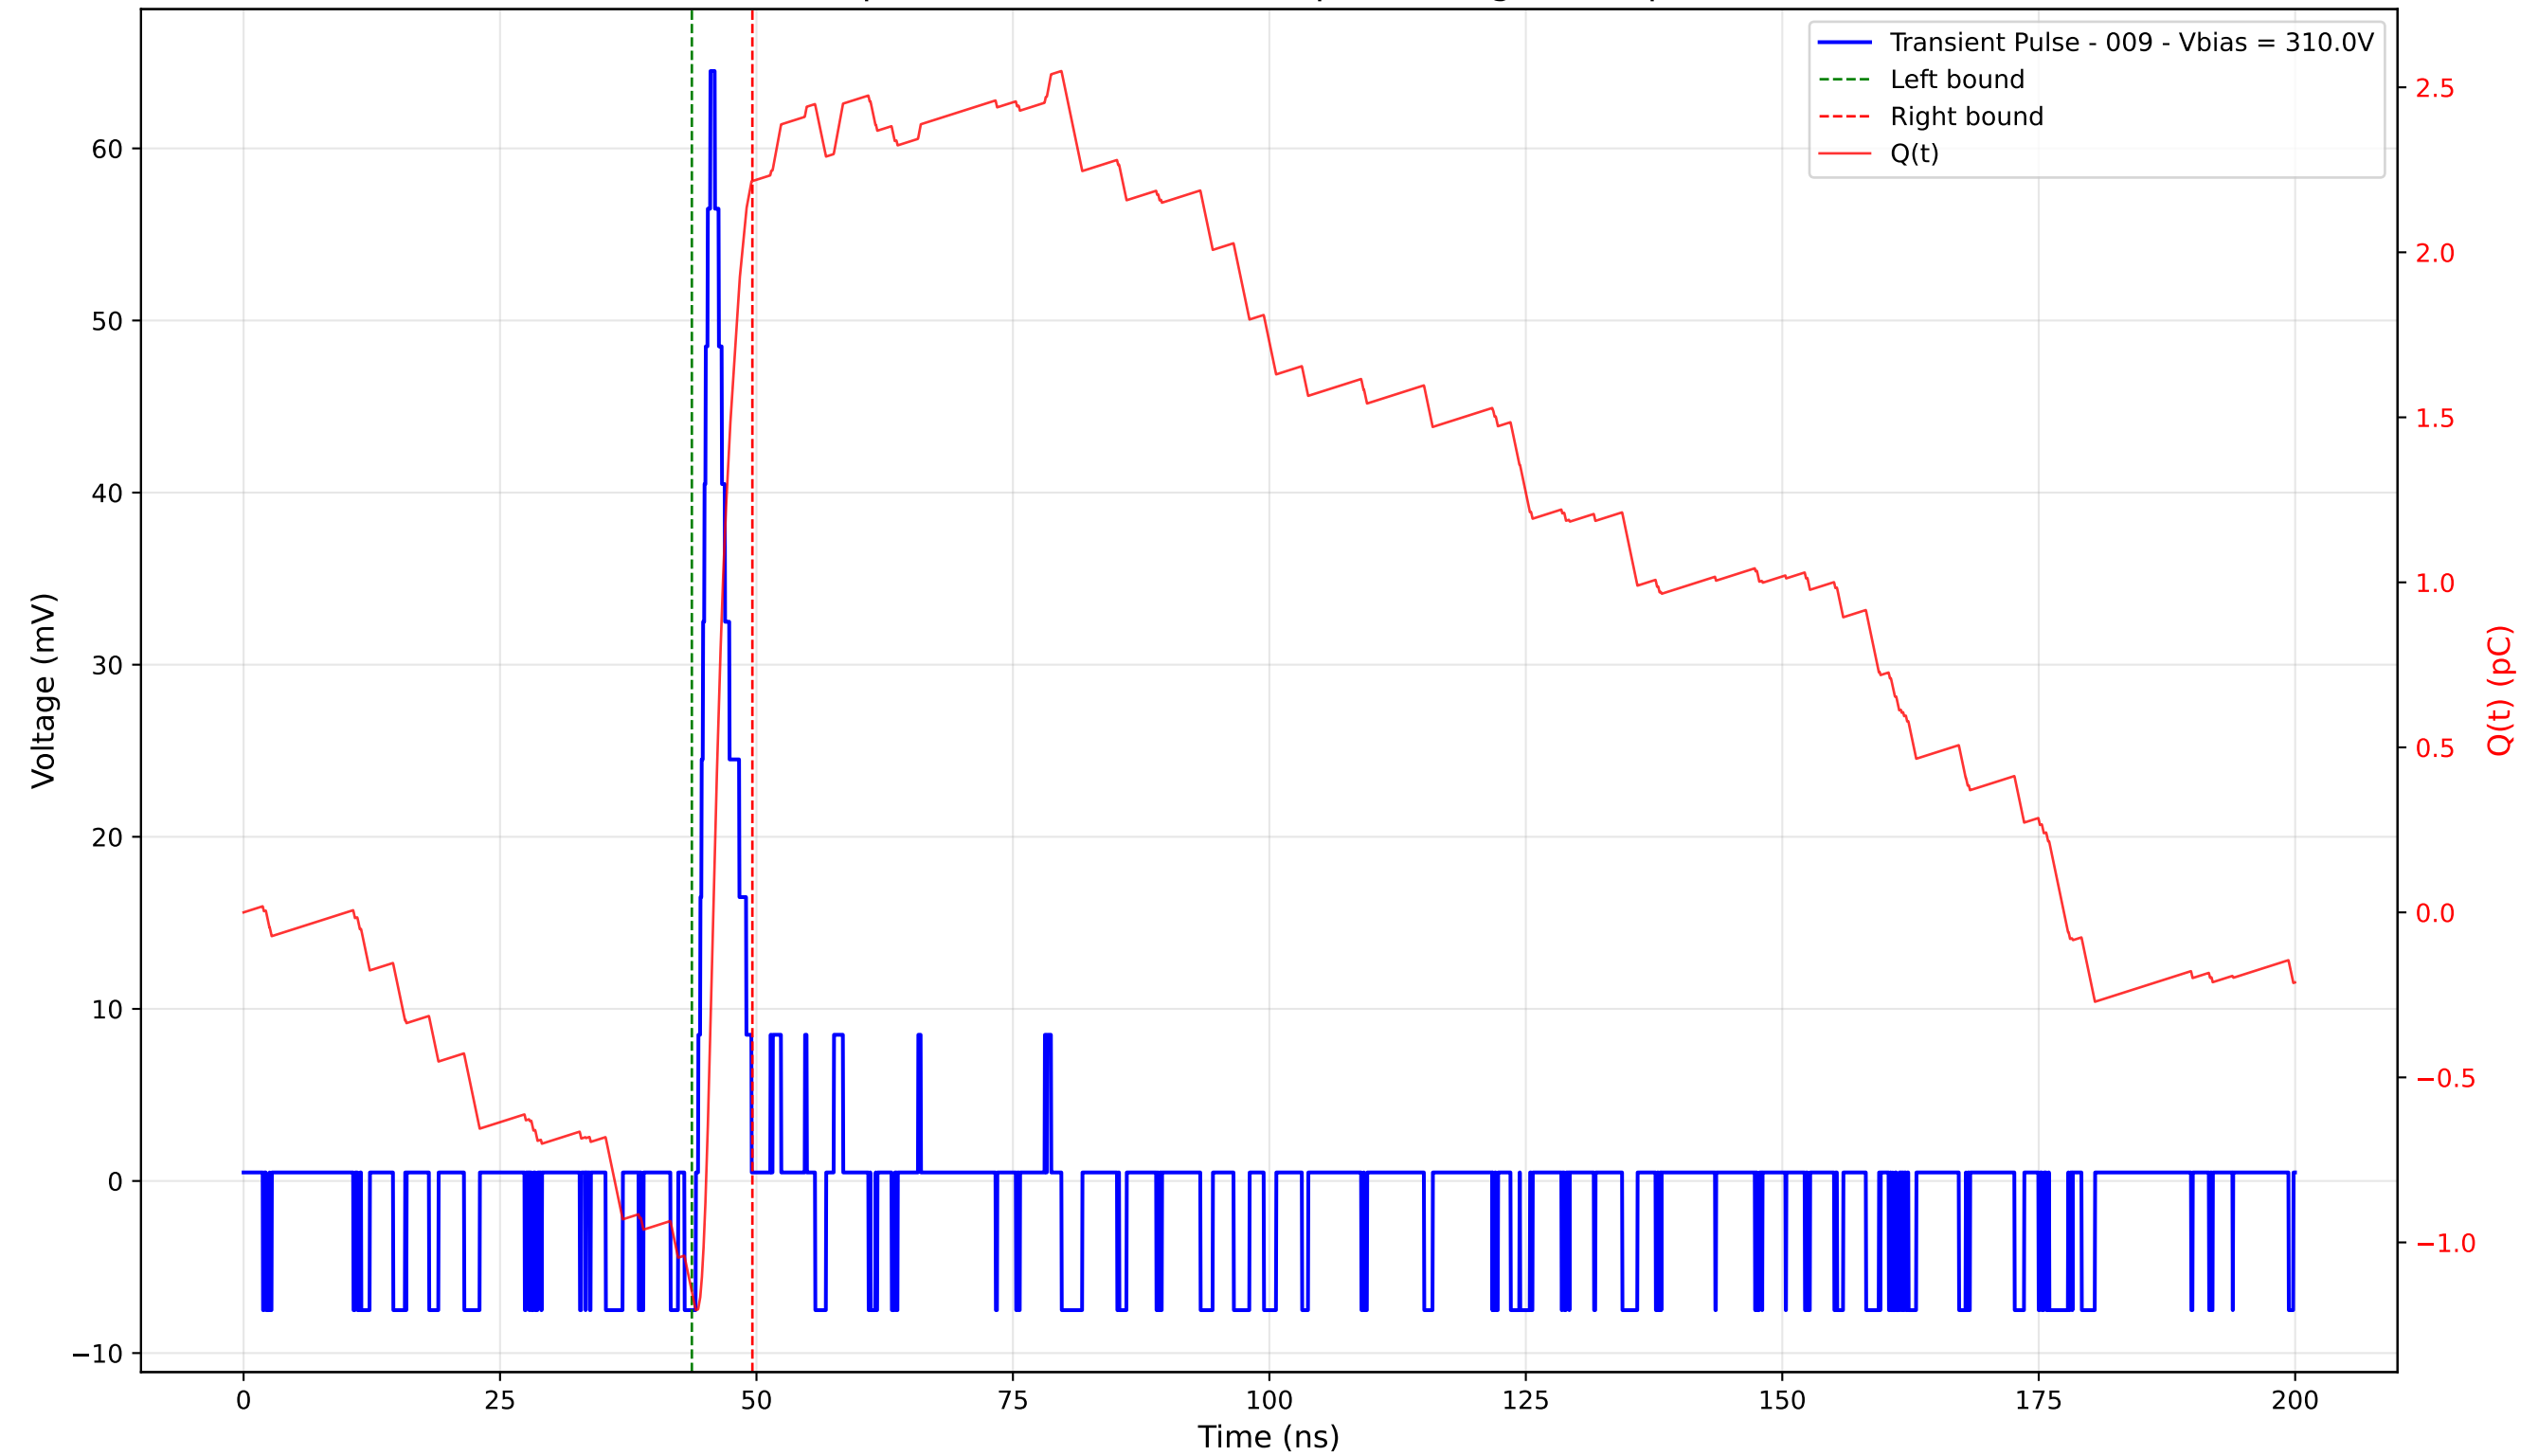


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.33 pC - Rise Time: 1.07 ns

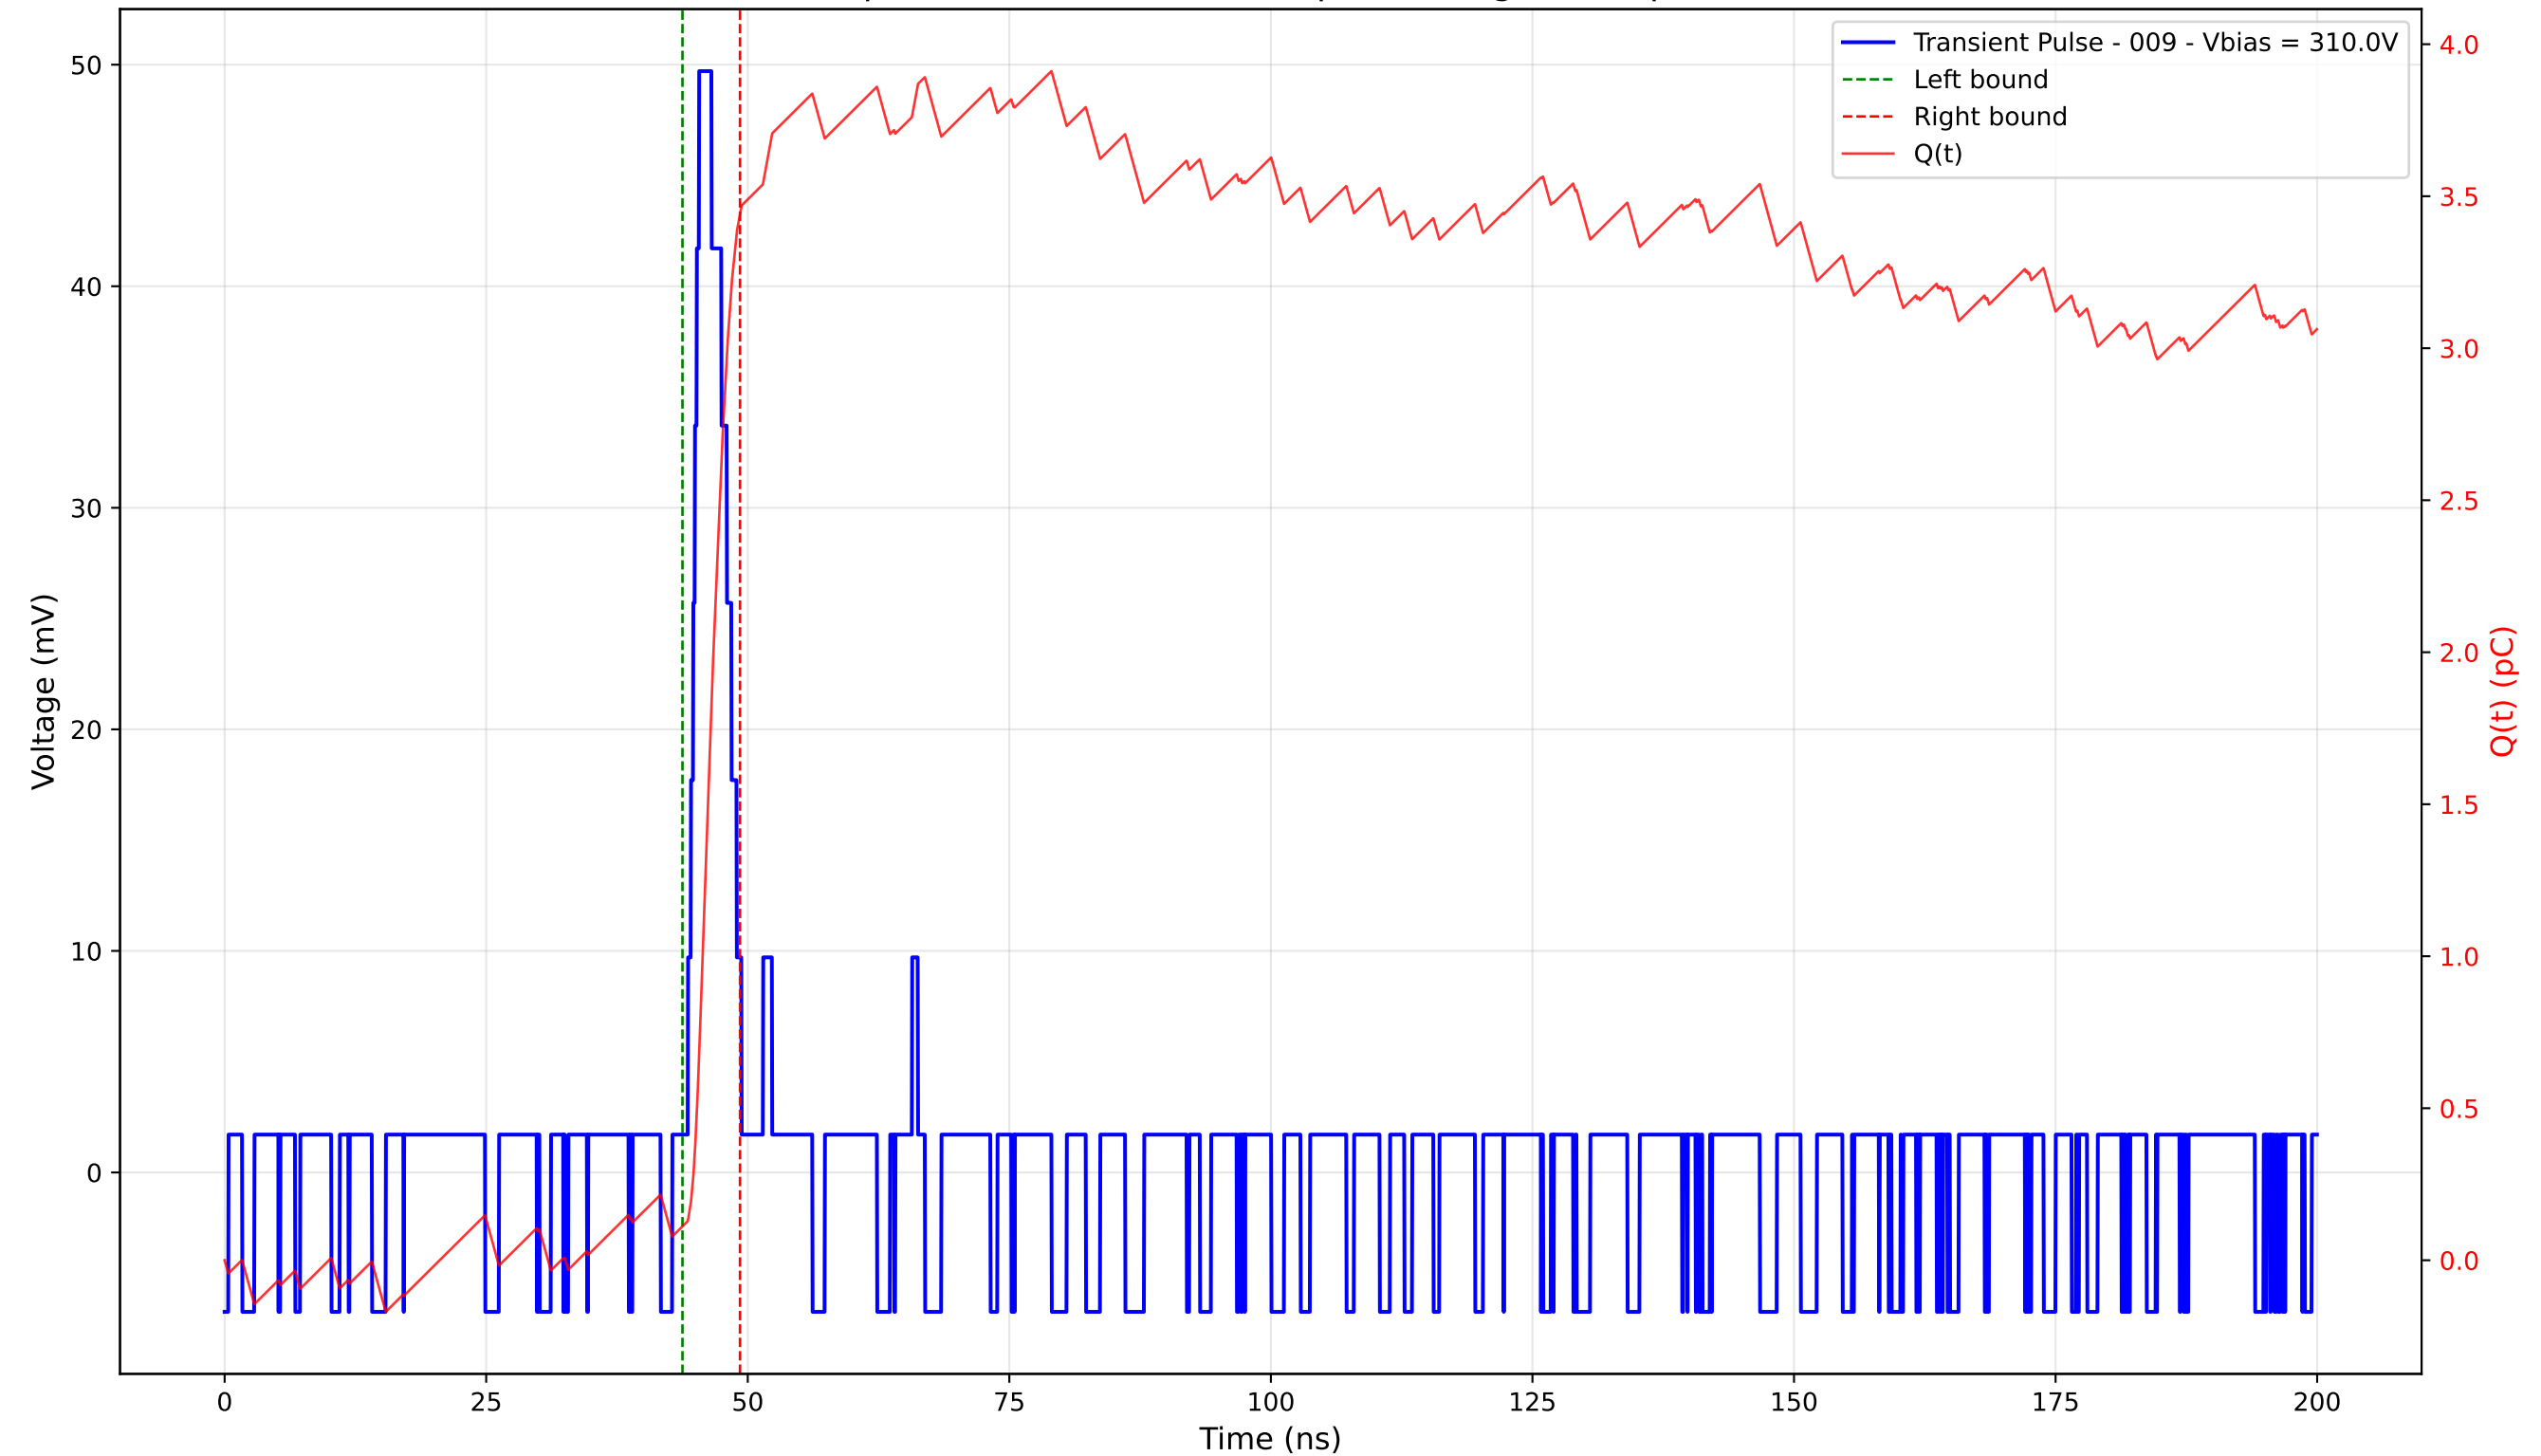


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 2.22 pC - Rise Time: 0.70 ns

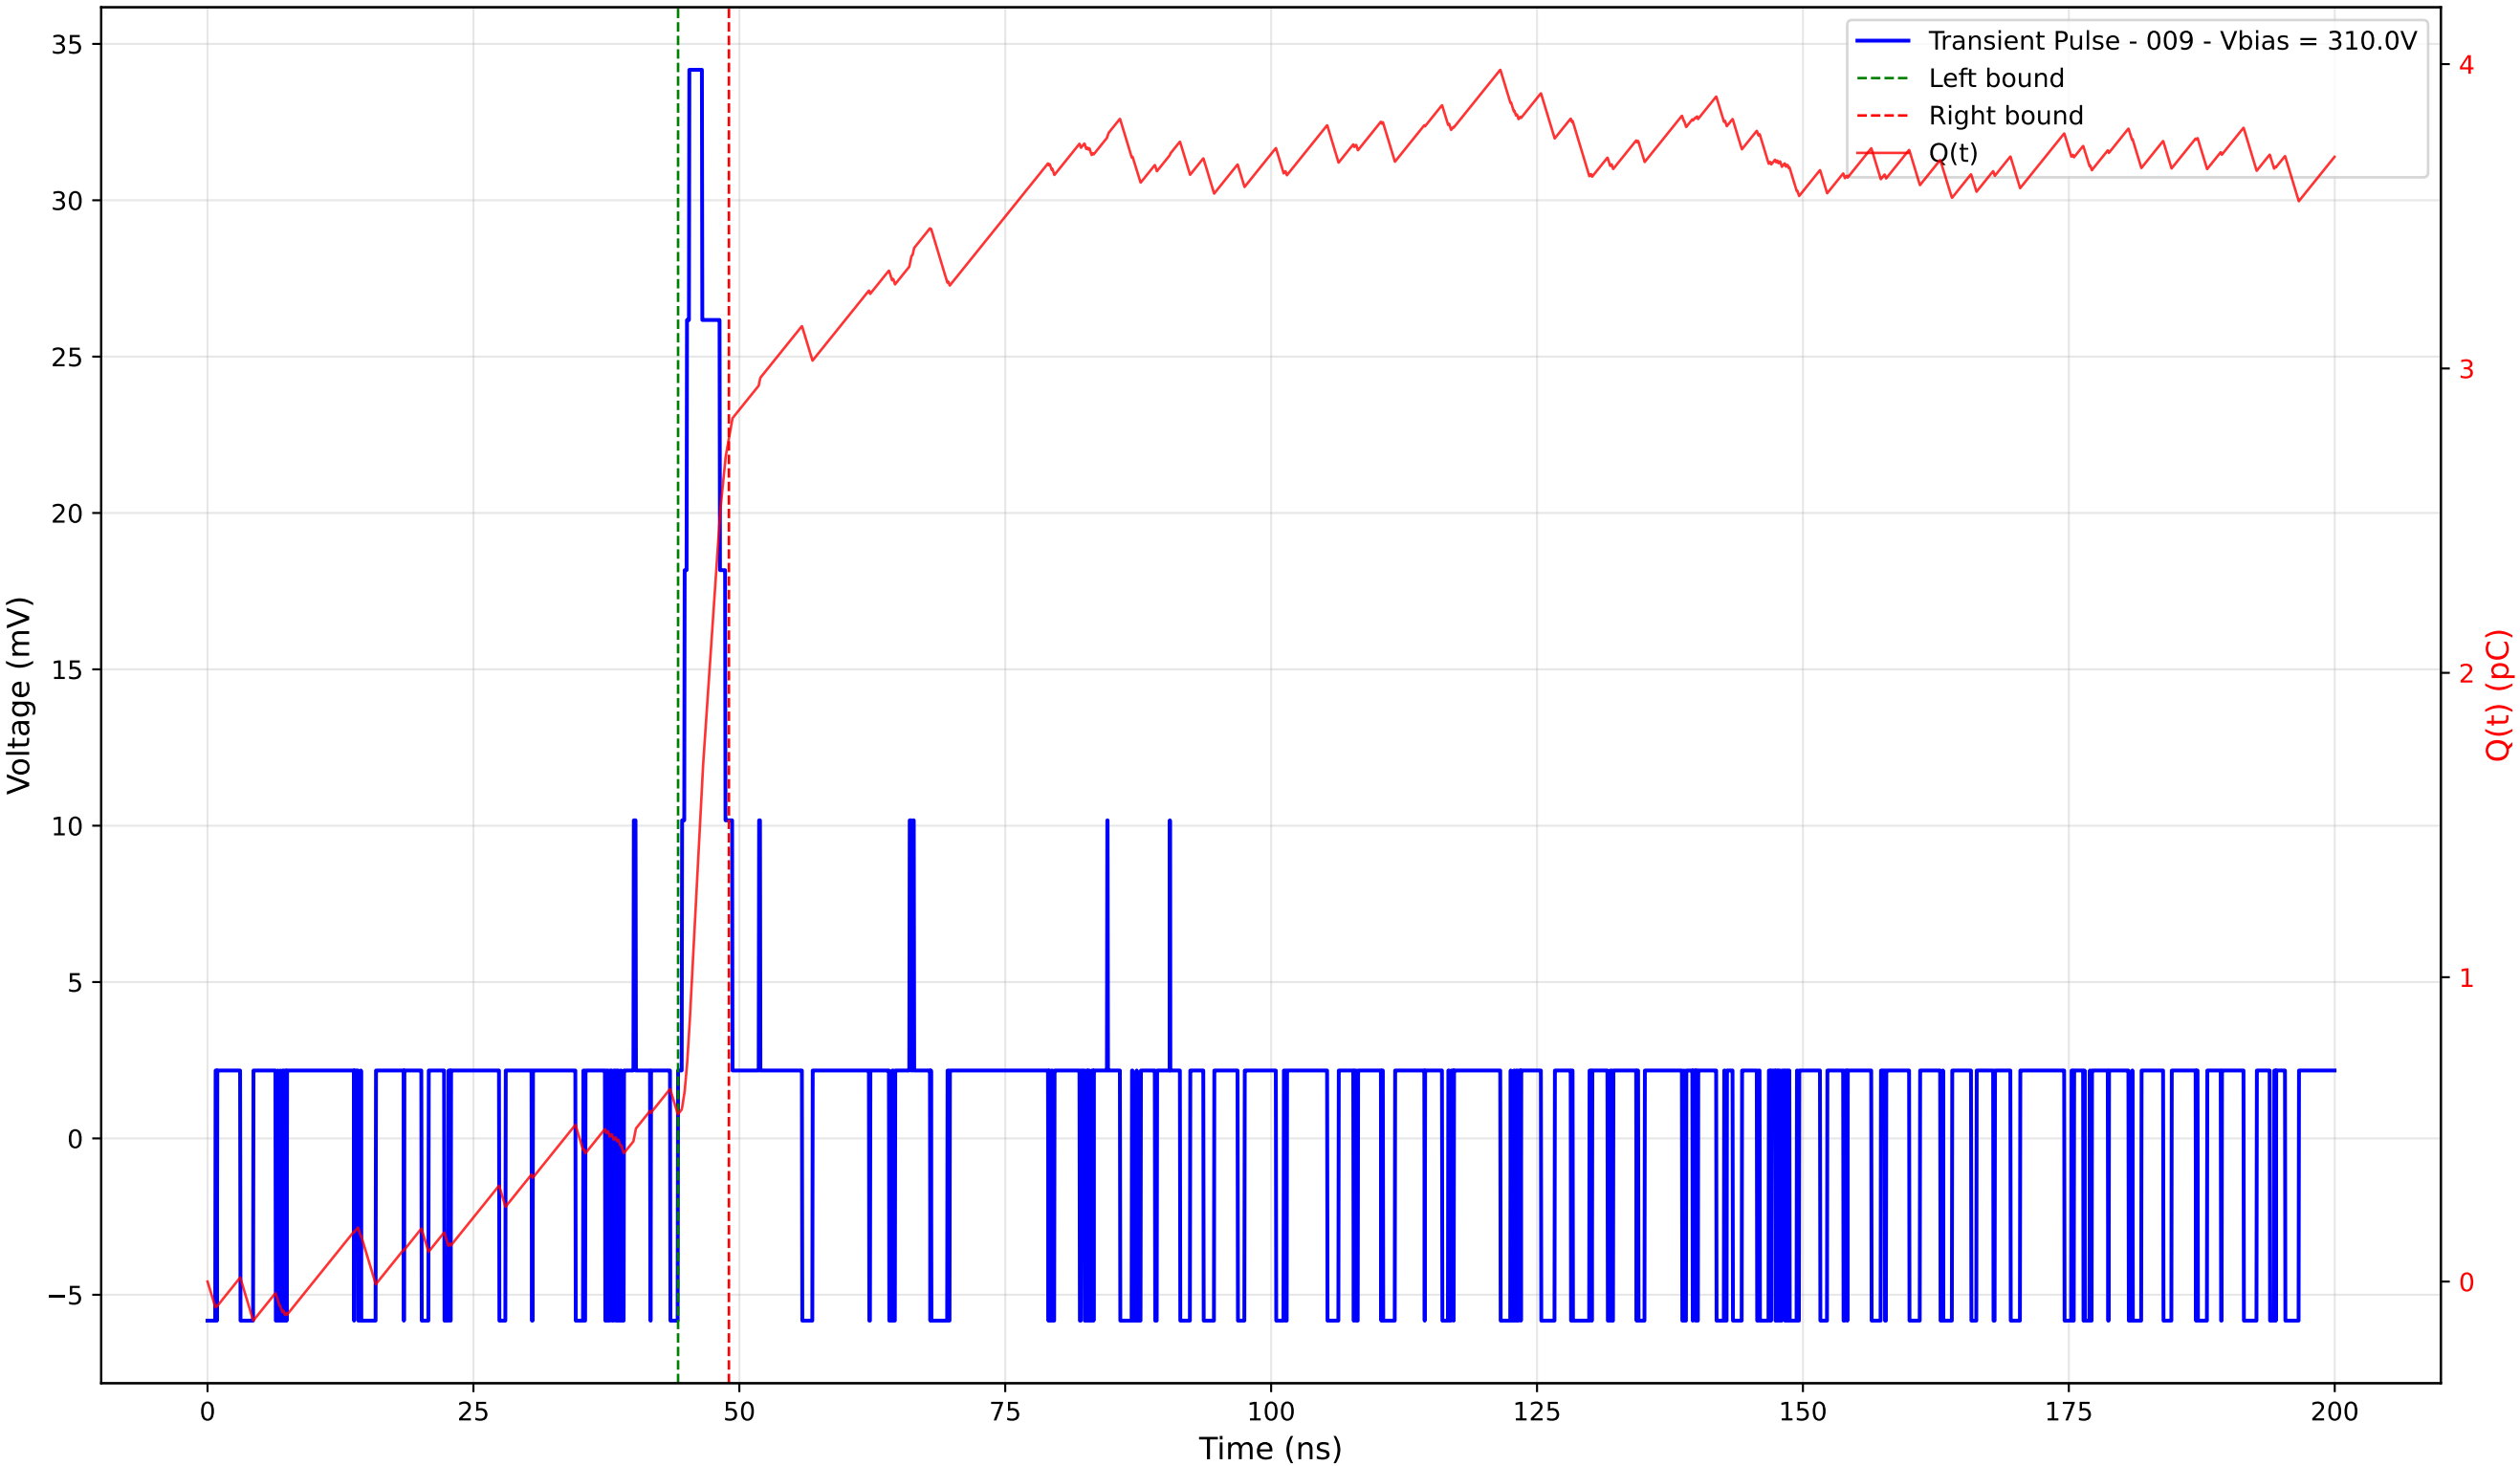


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 1.16 pC - Rise Time: 0.44 ns

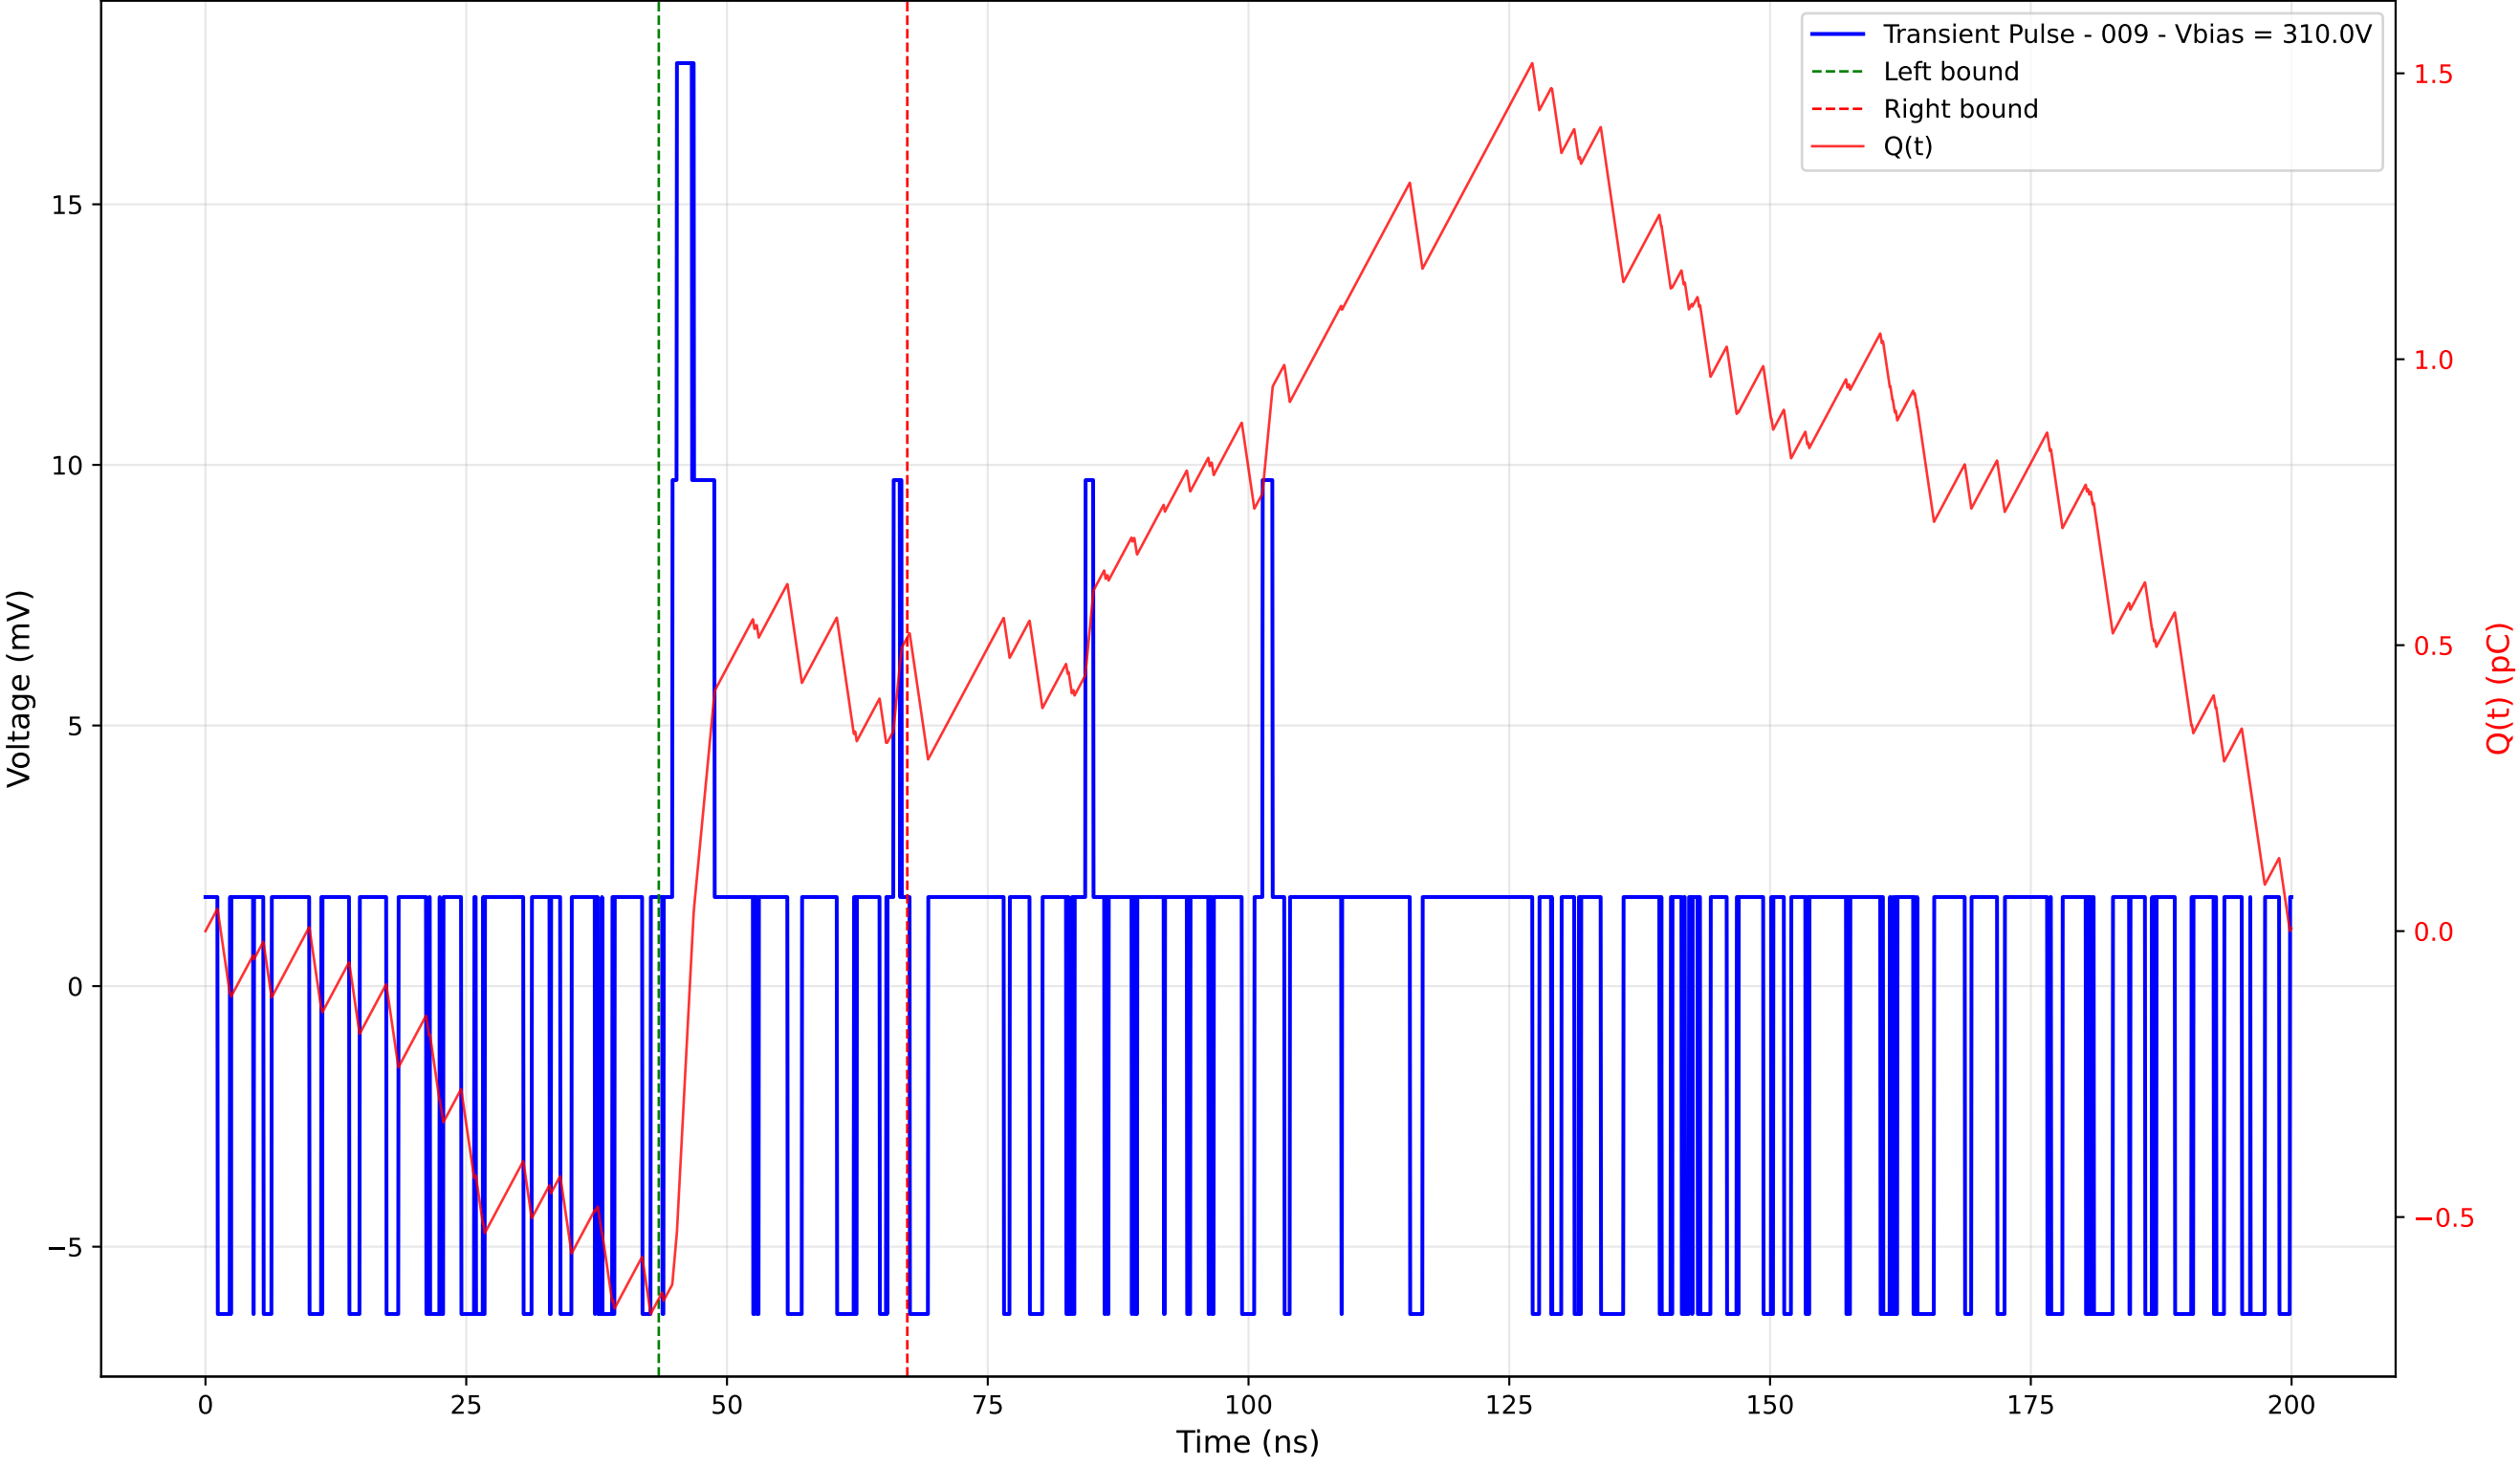


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 0.55 pC - Rise Time: 0.82 ns

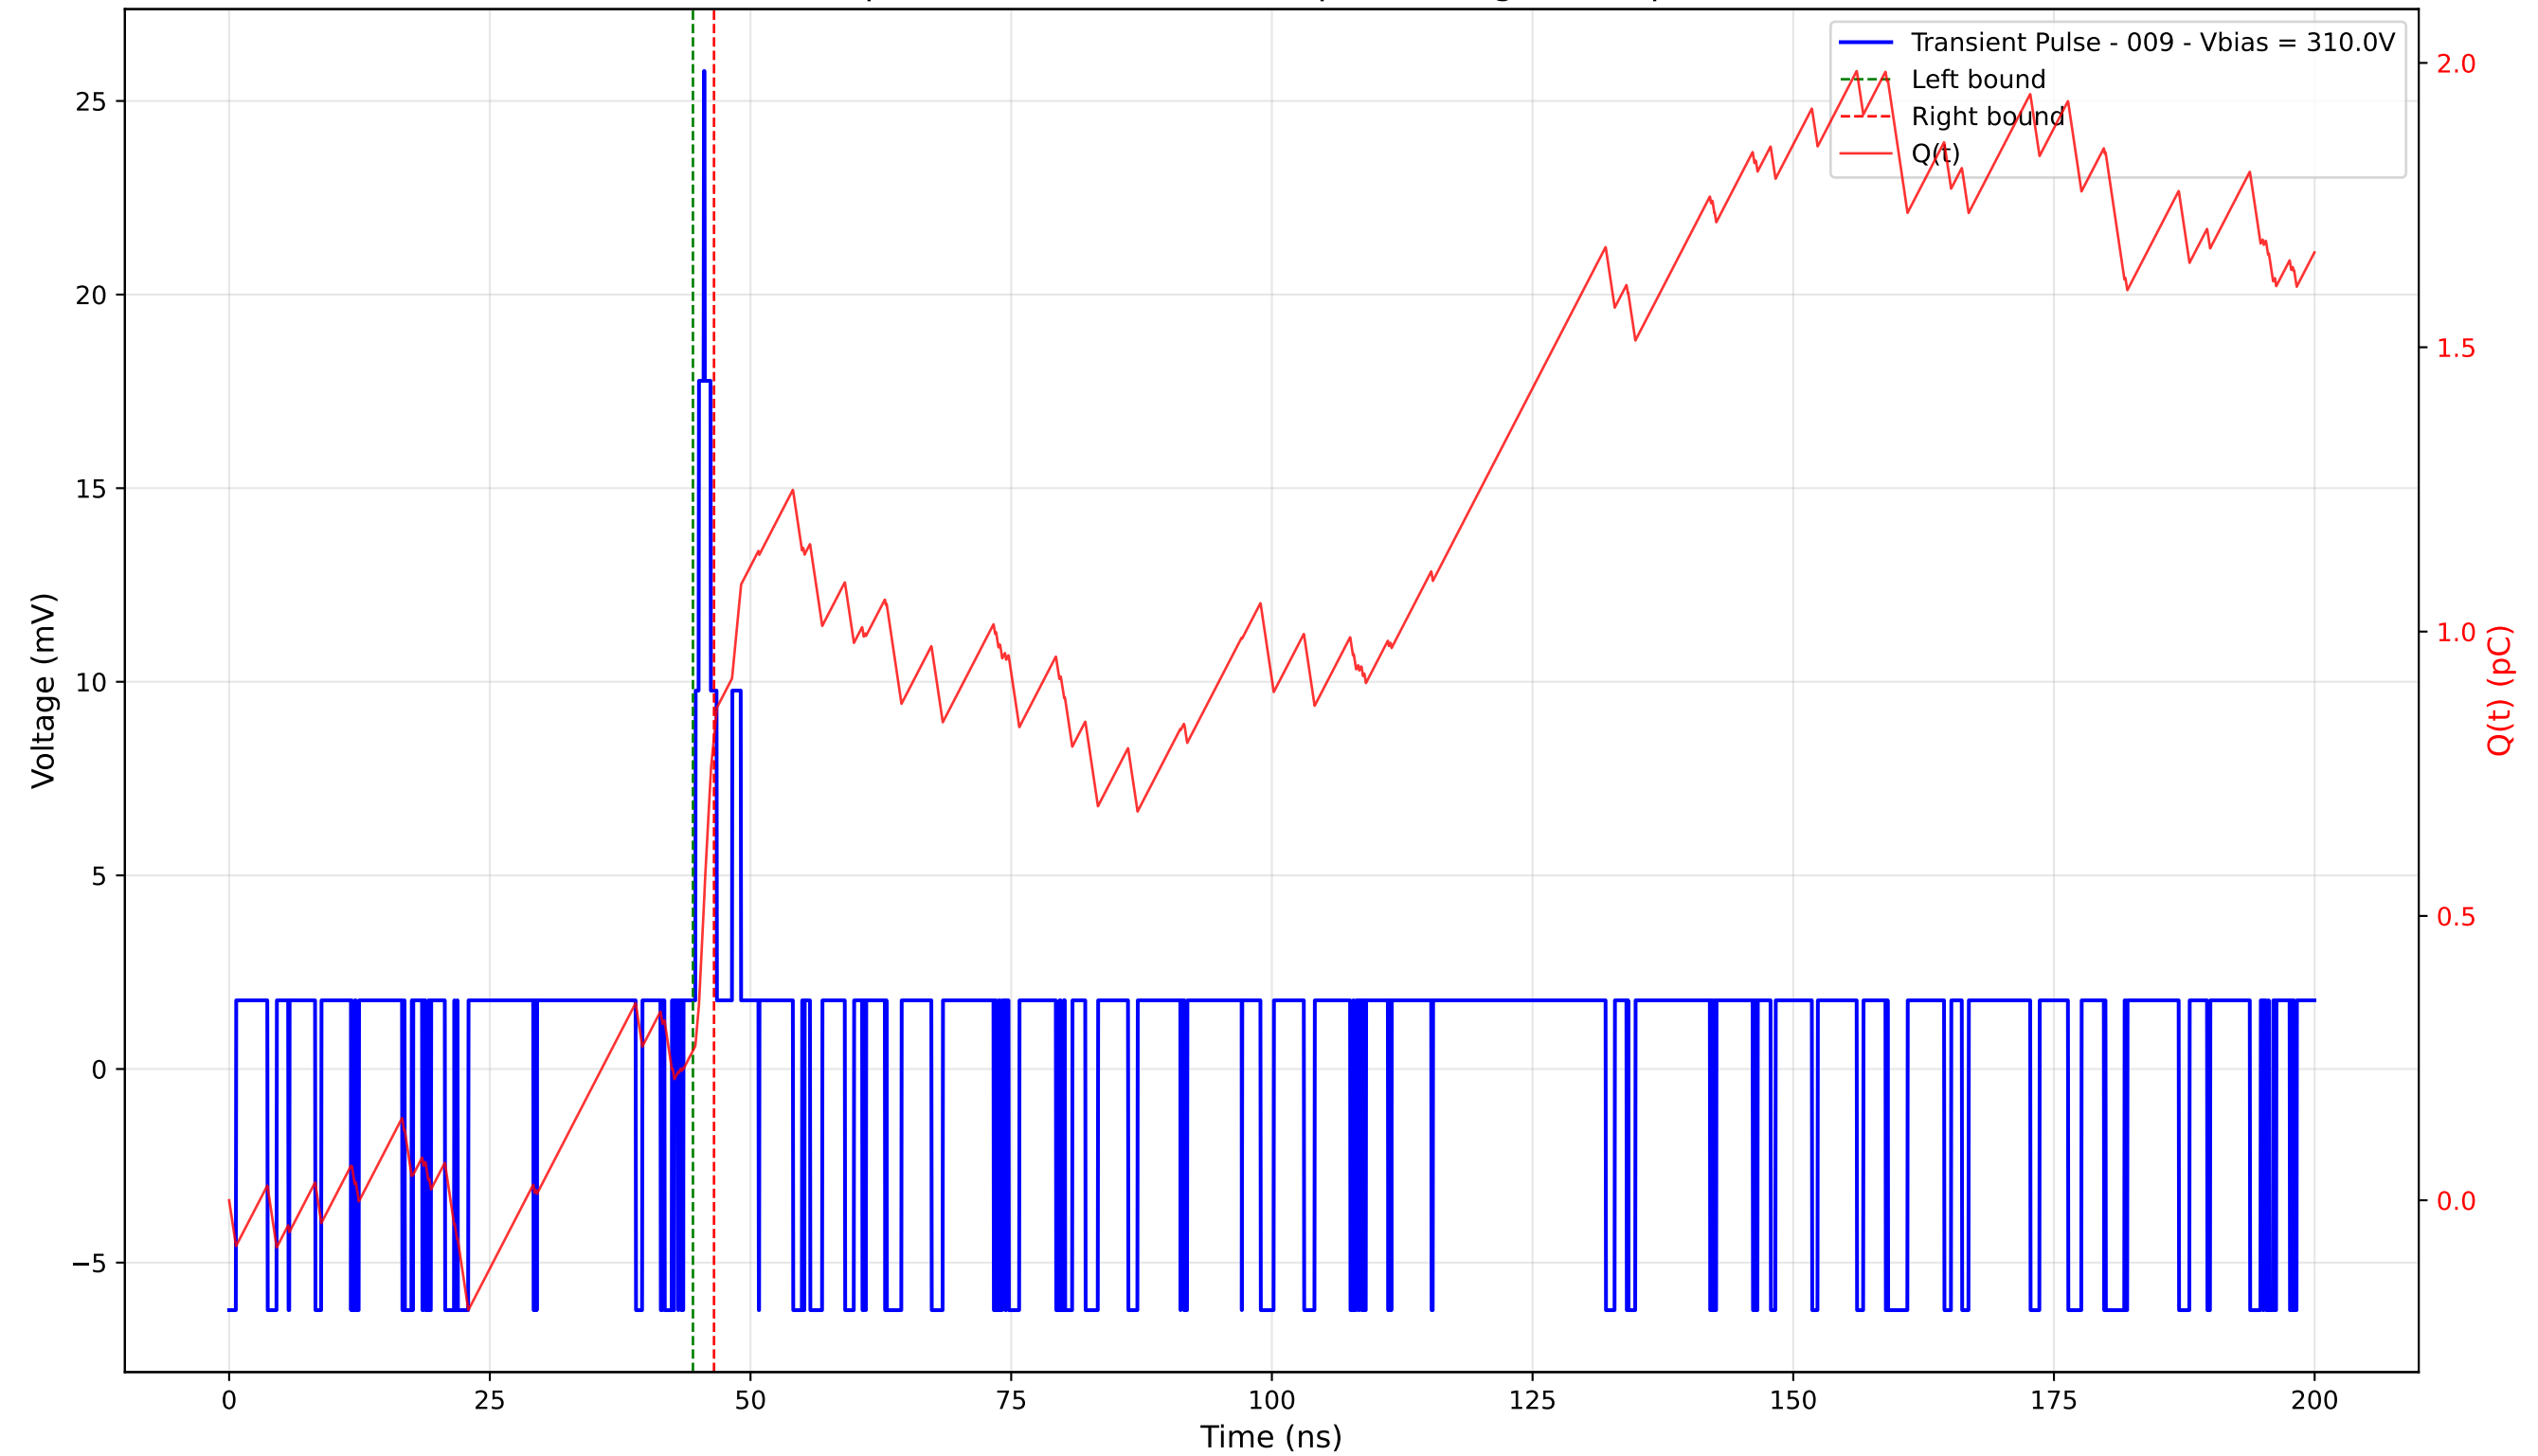


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 1.70 pC - Rise Time: 0.62 ns

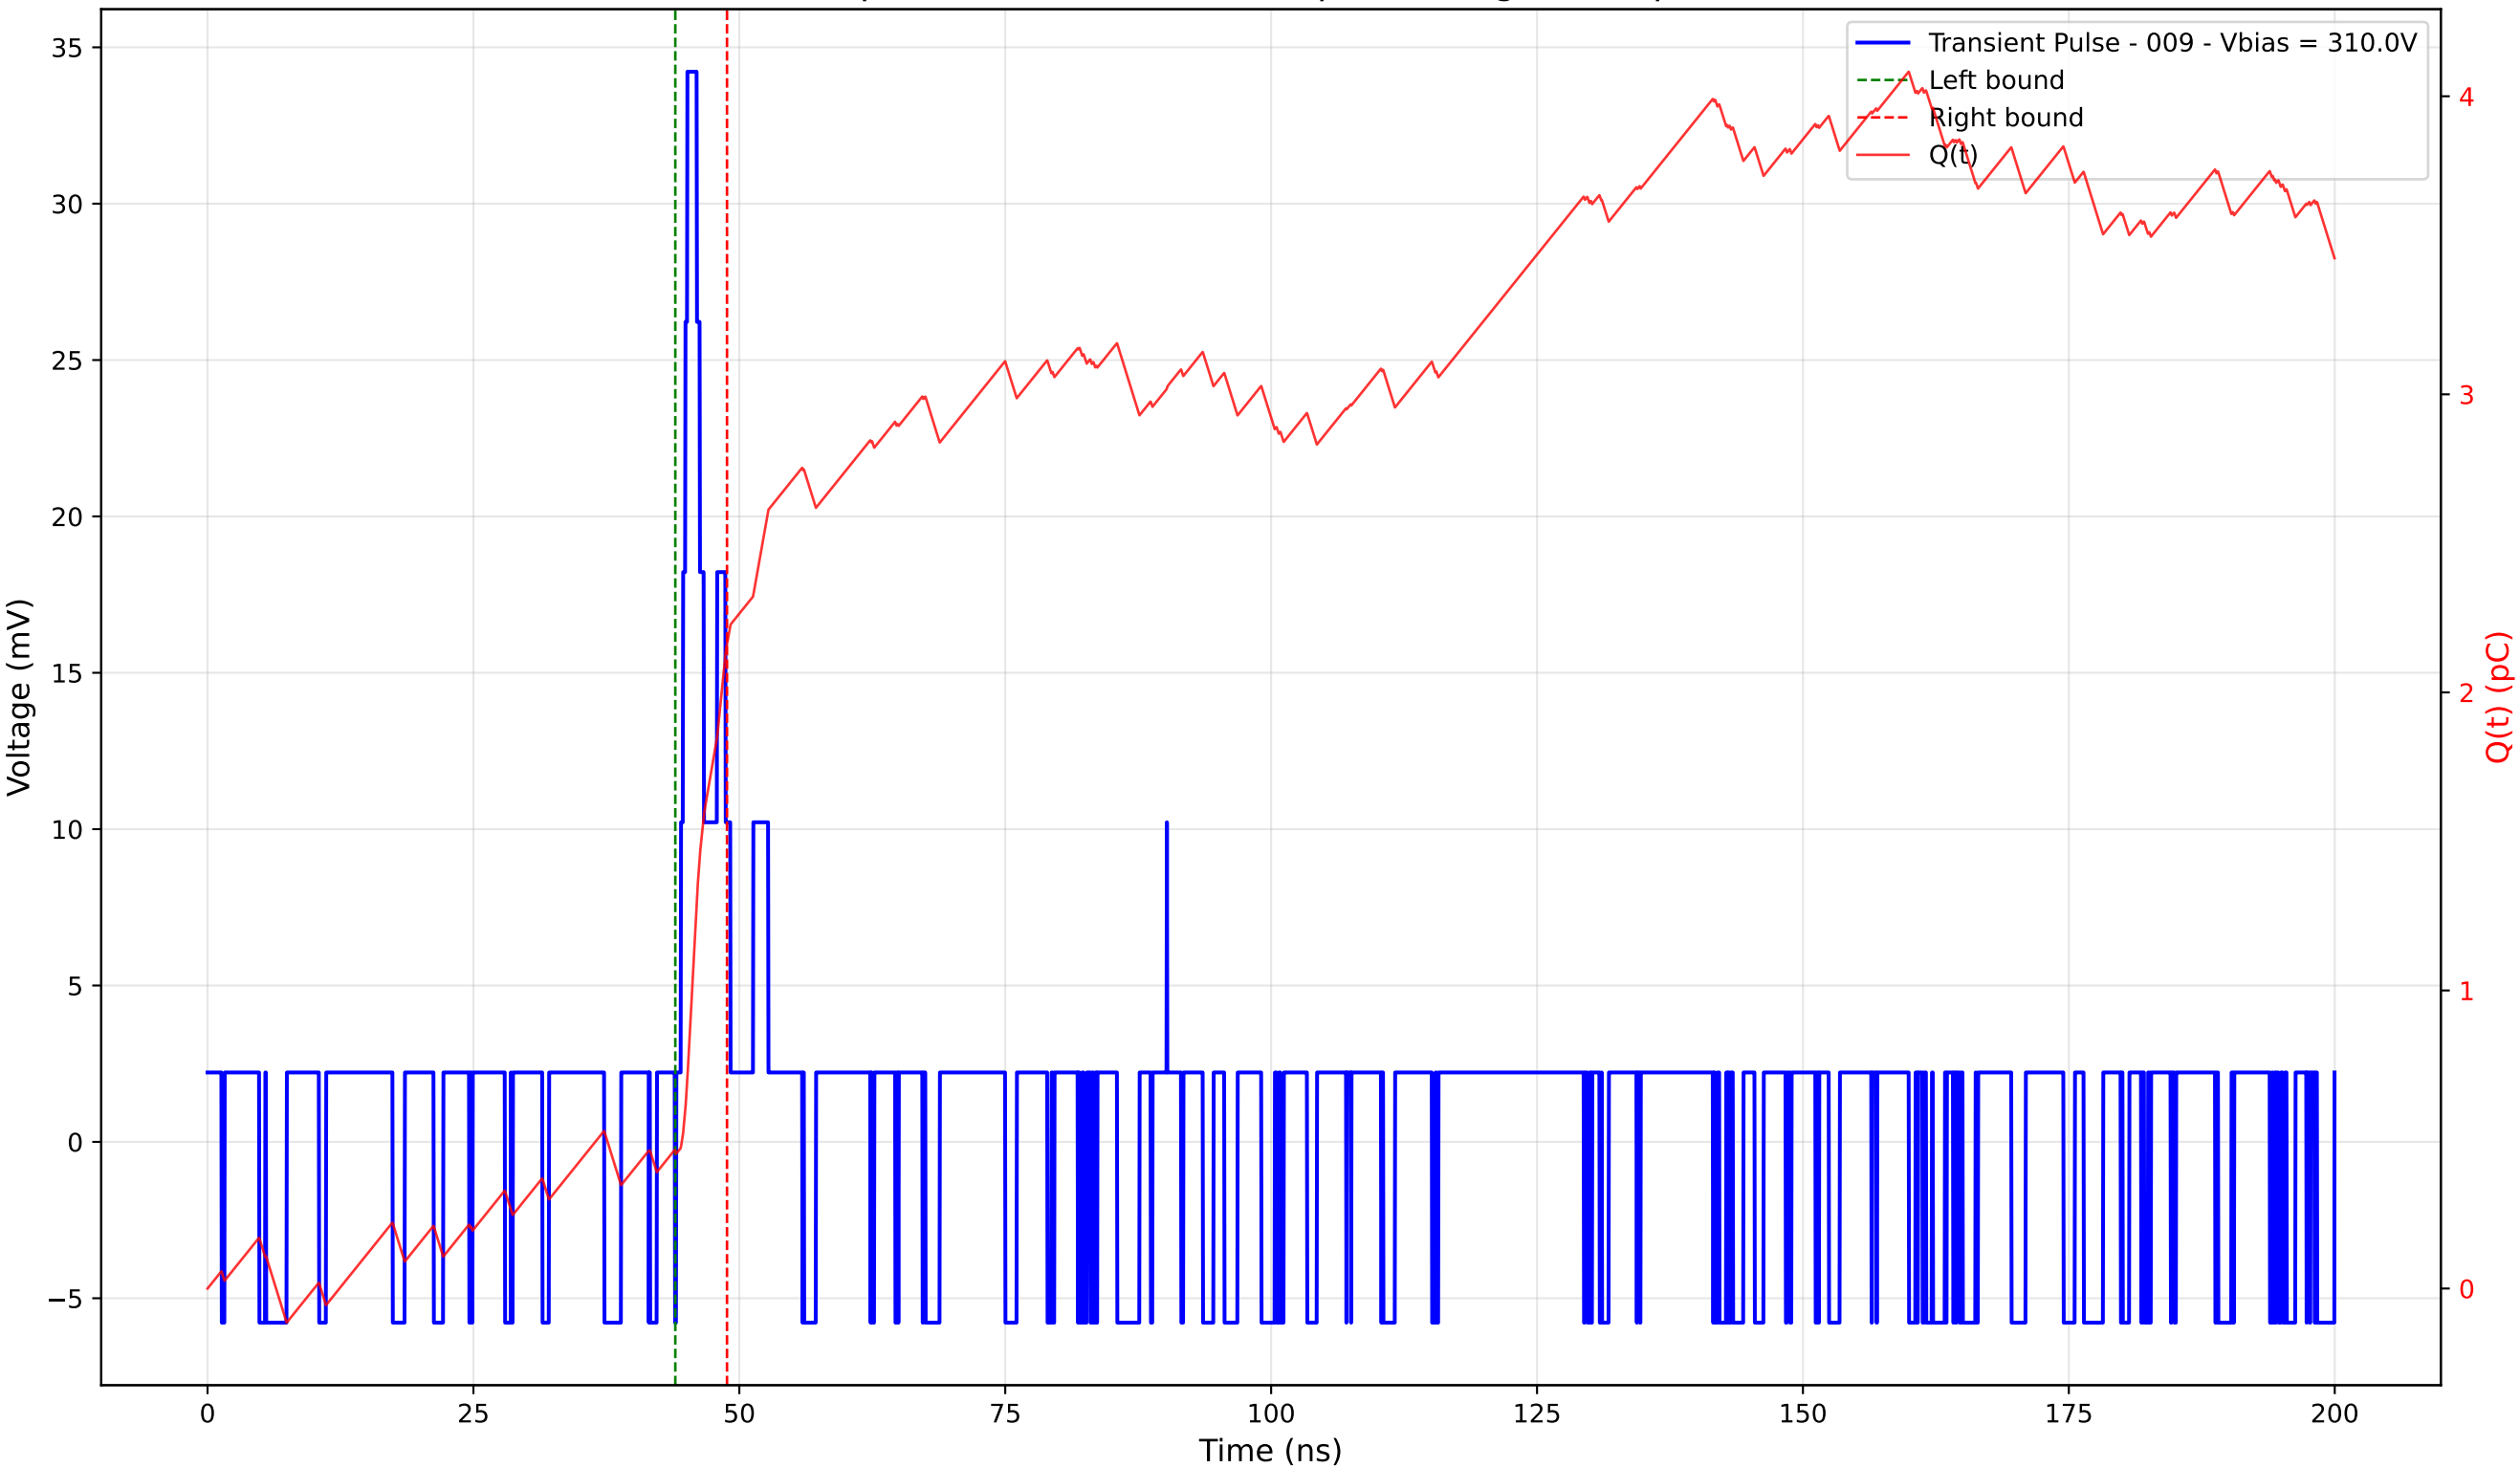


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 3.26 pC - Rise Time: 1.21 ns

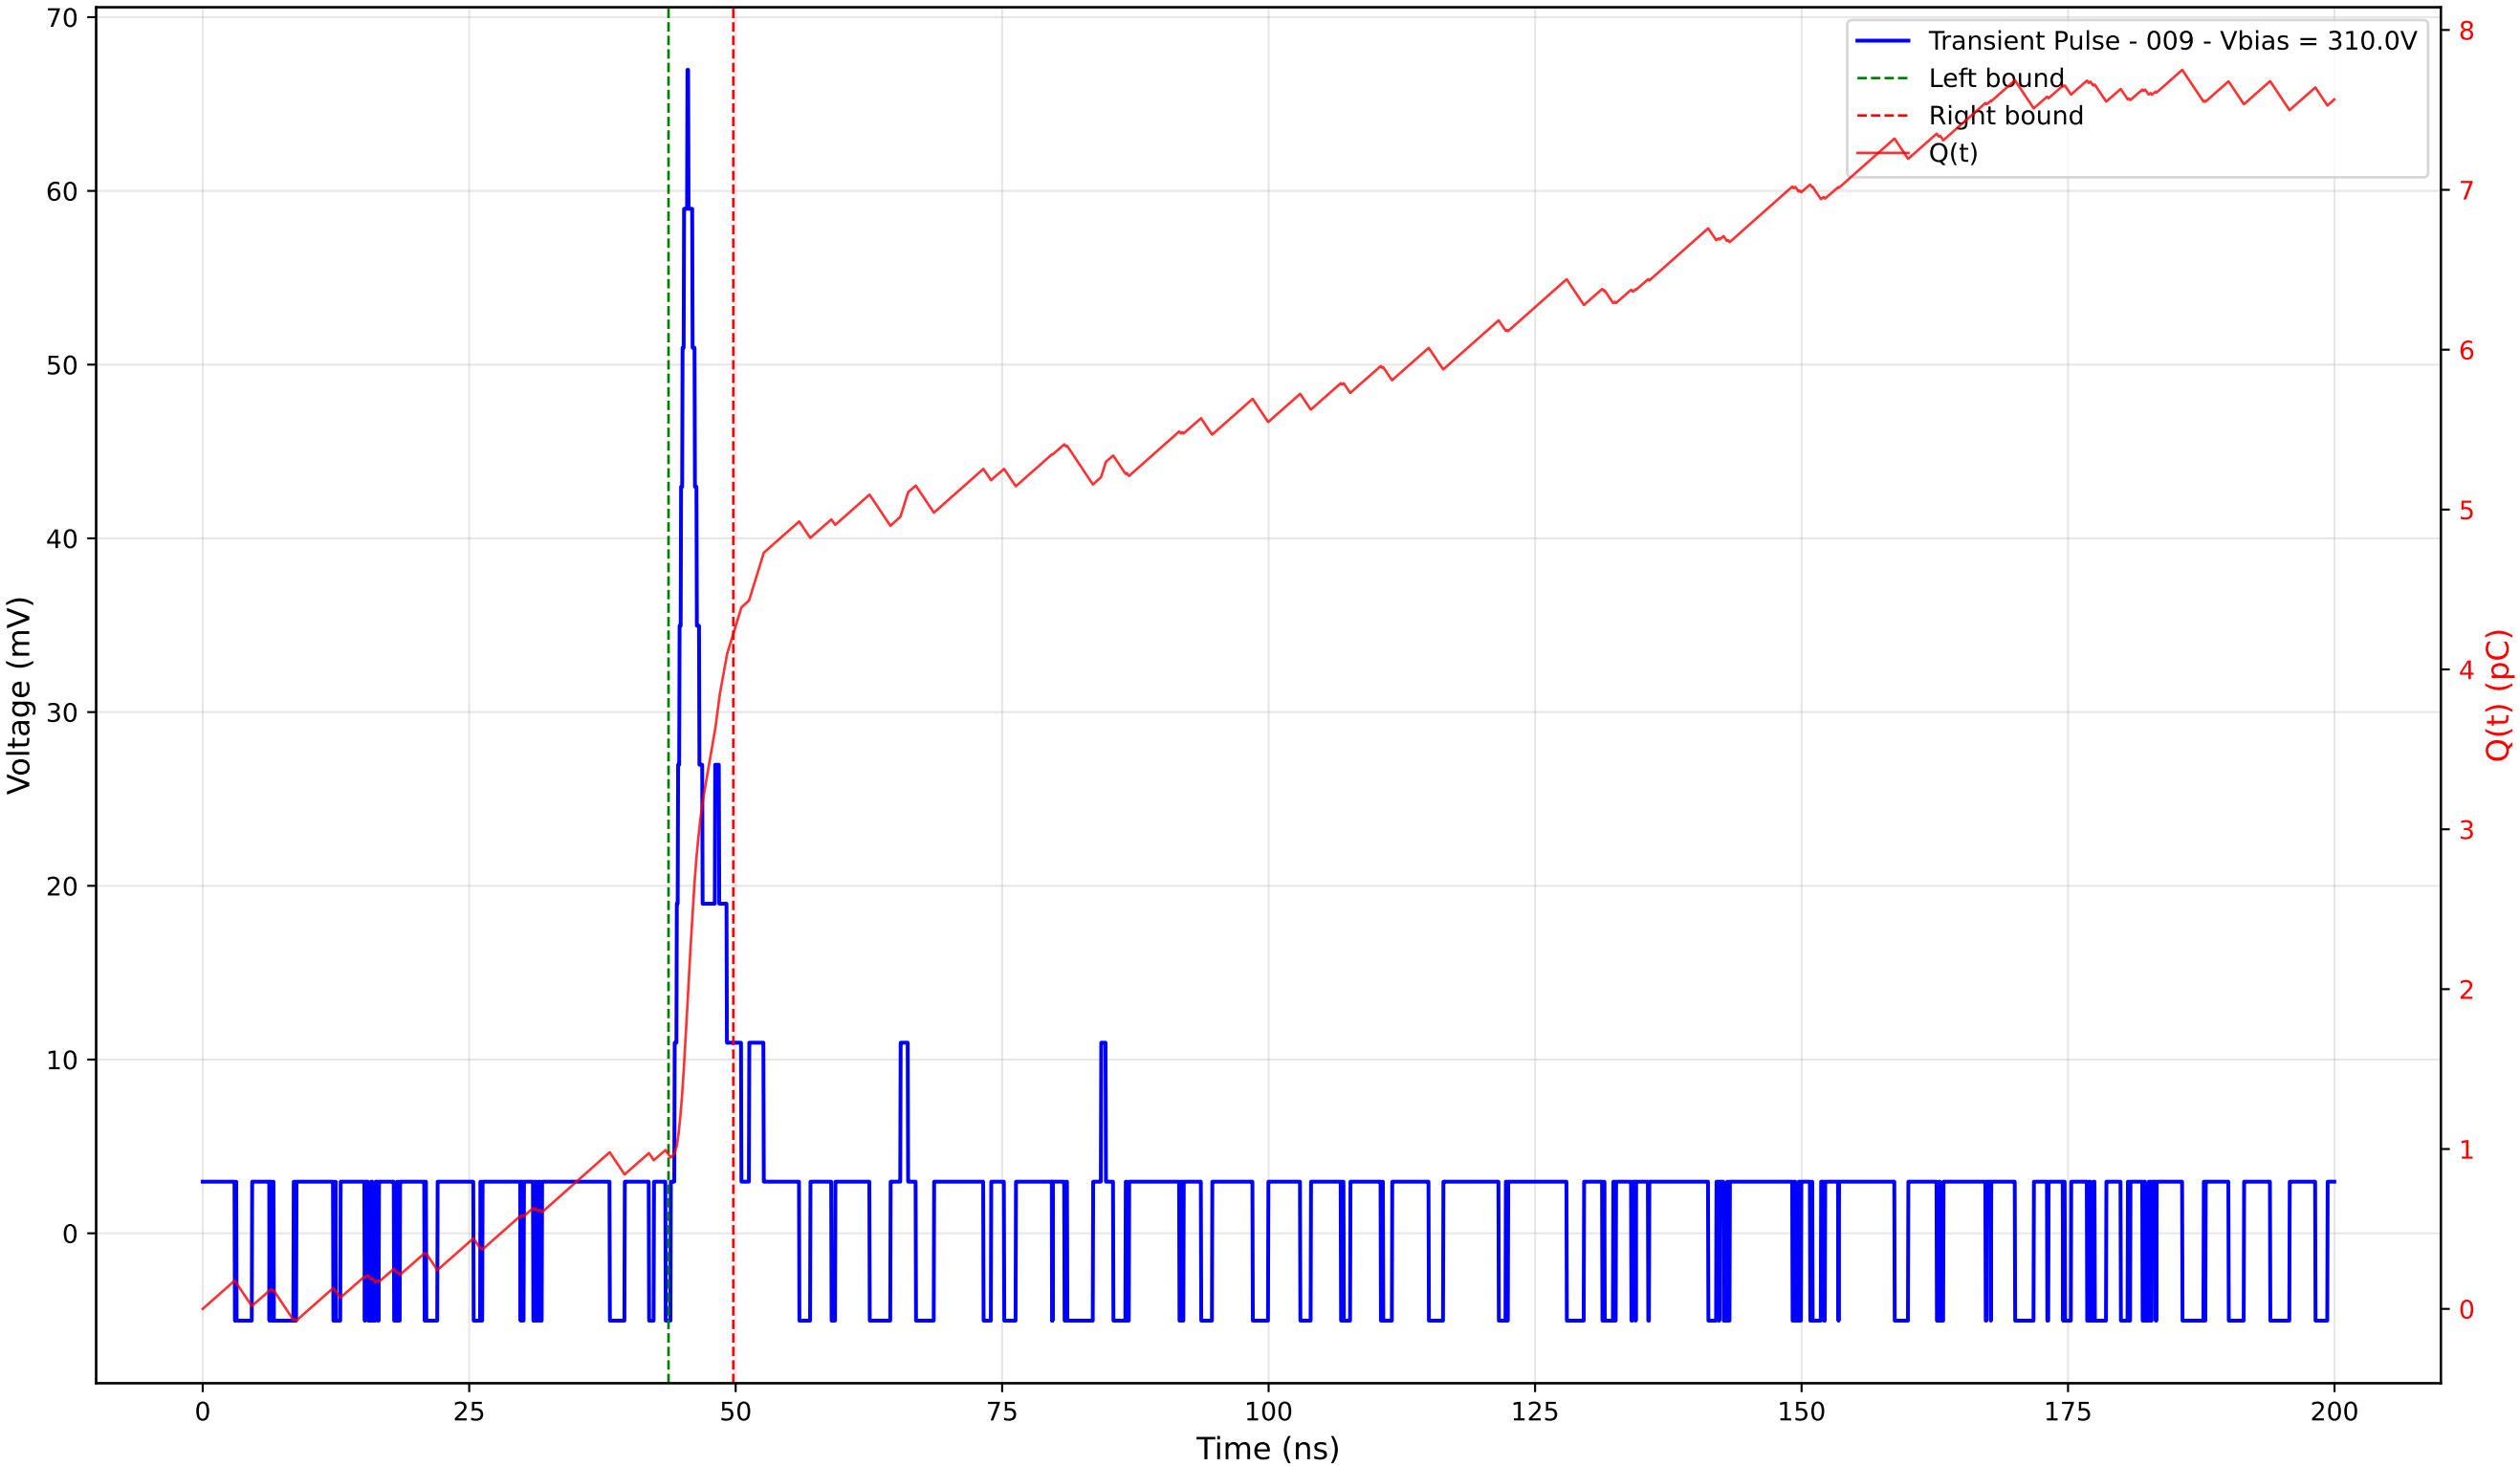


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 6.93 pC - Rise Time: 0.88 ns

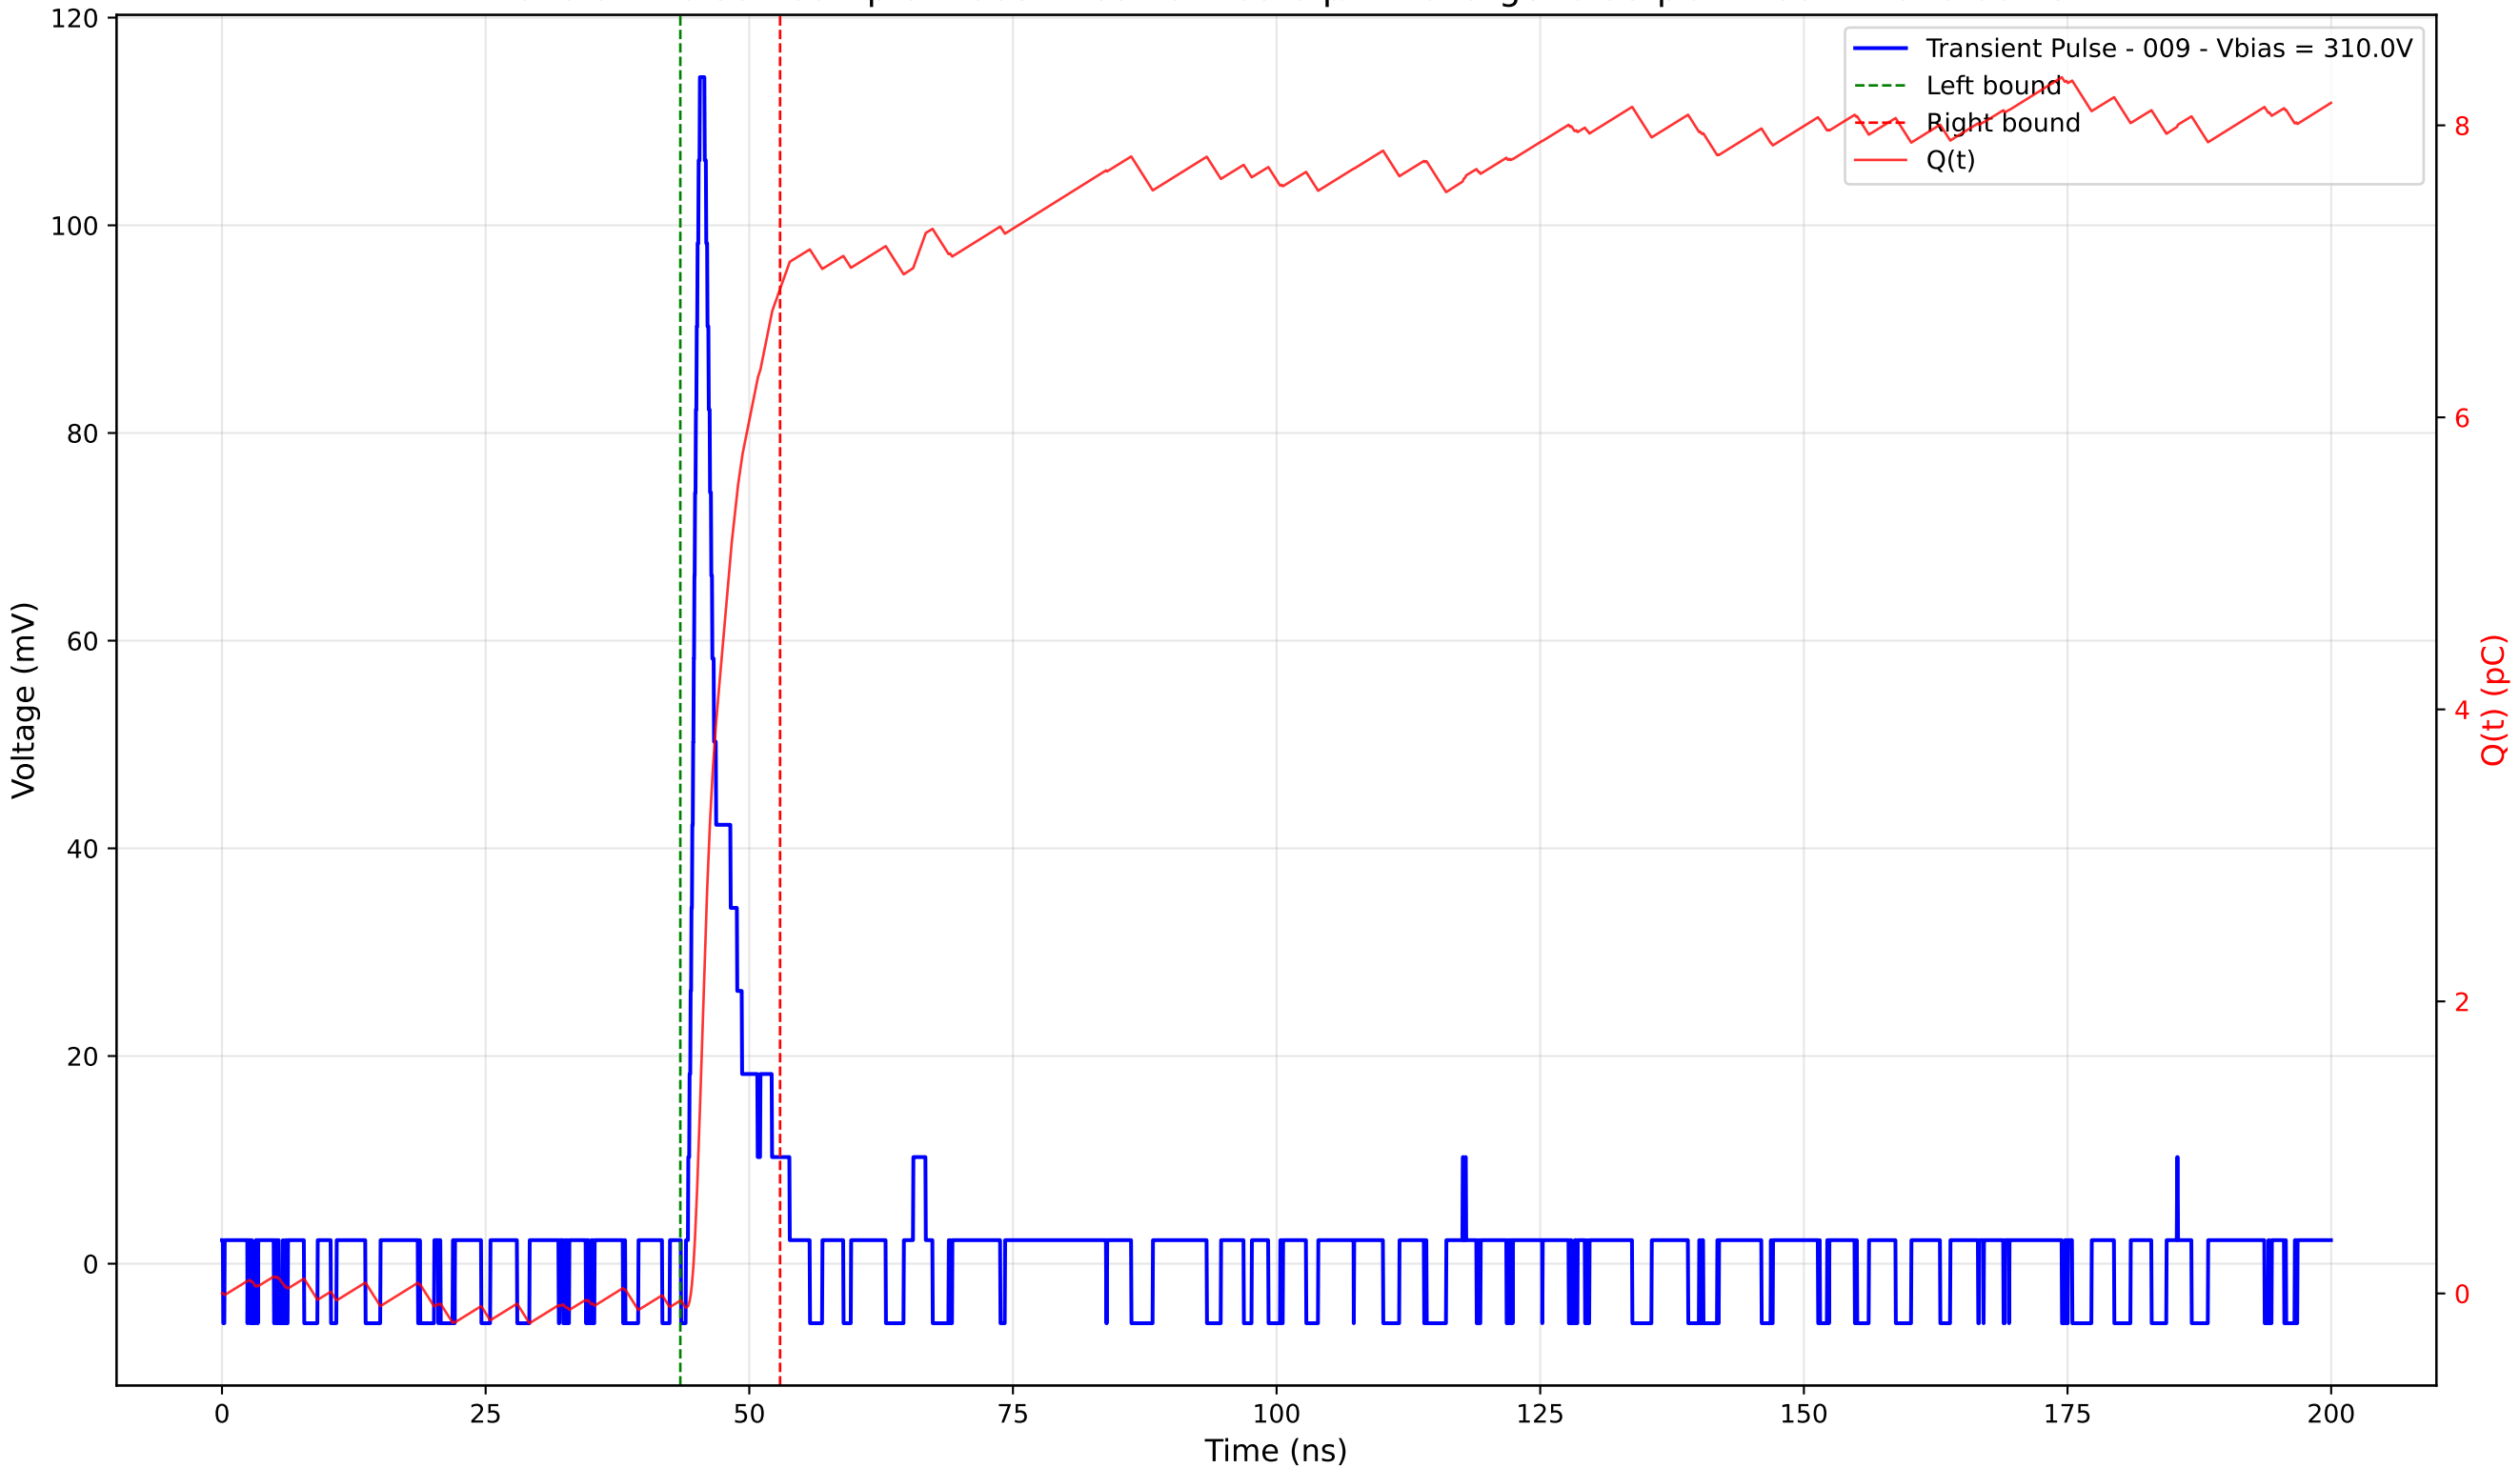


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 11.58 pC - Rise Time: 0.86 ns

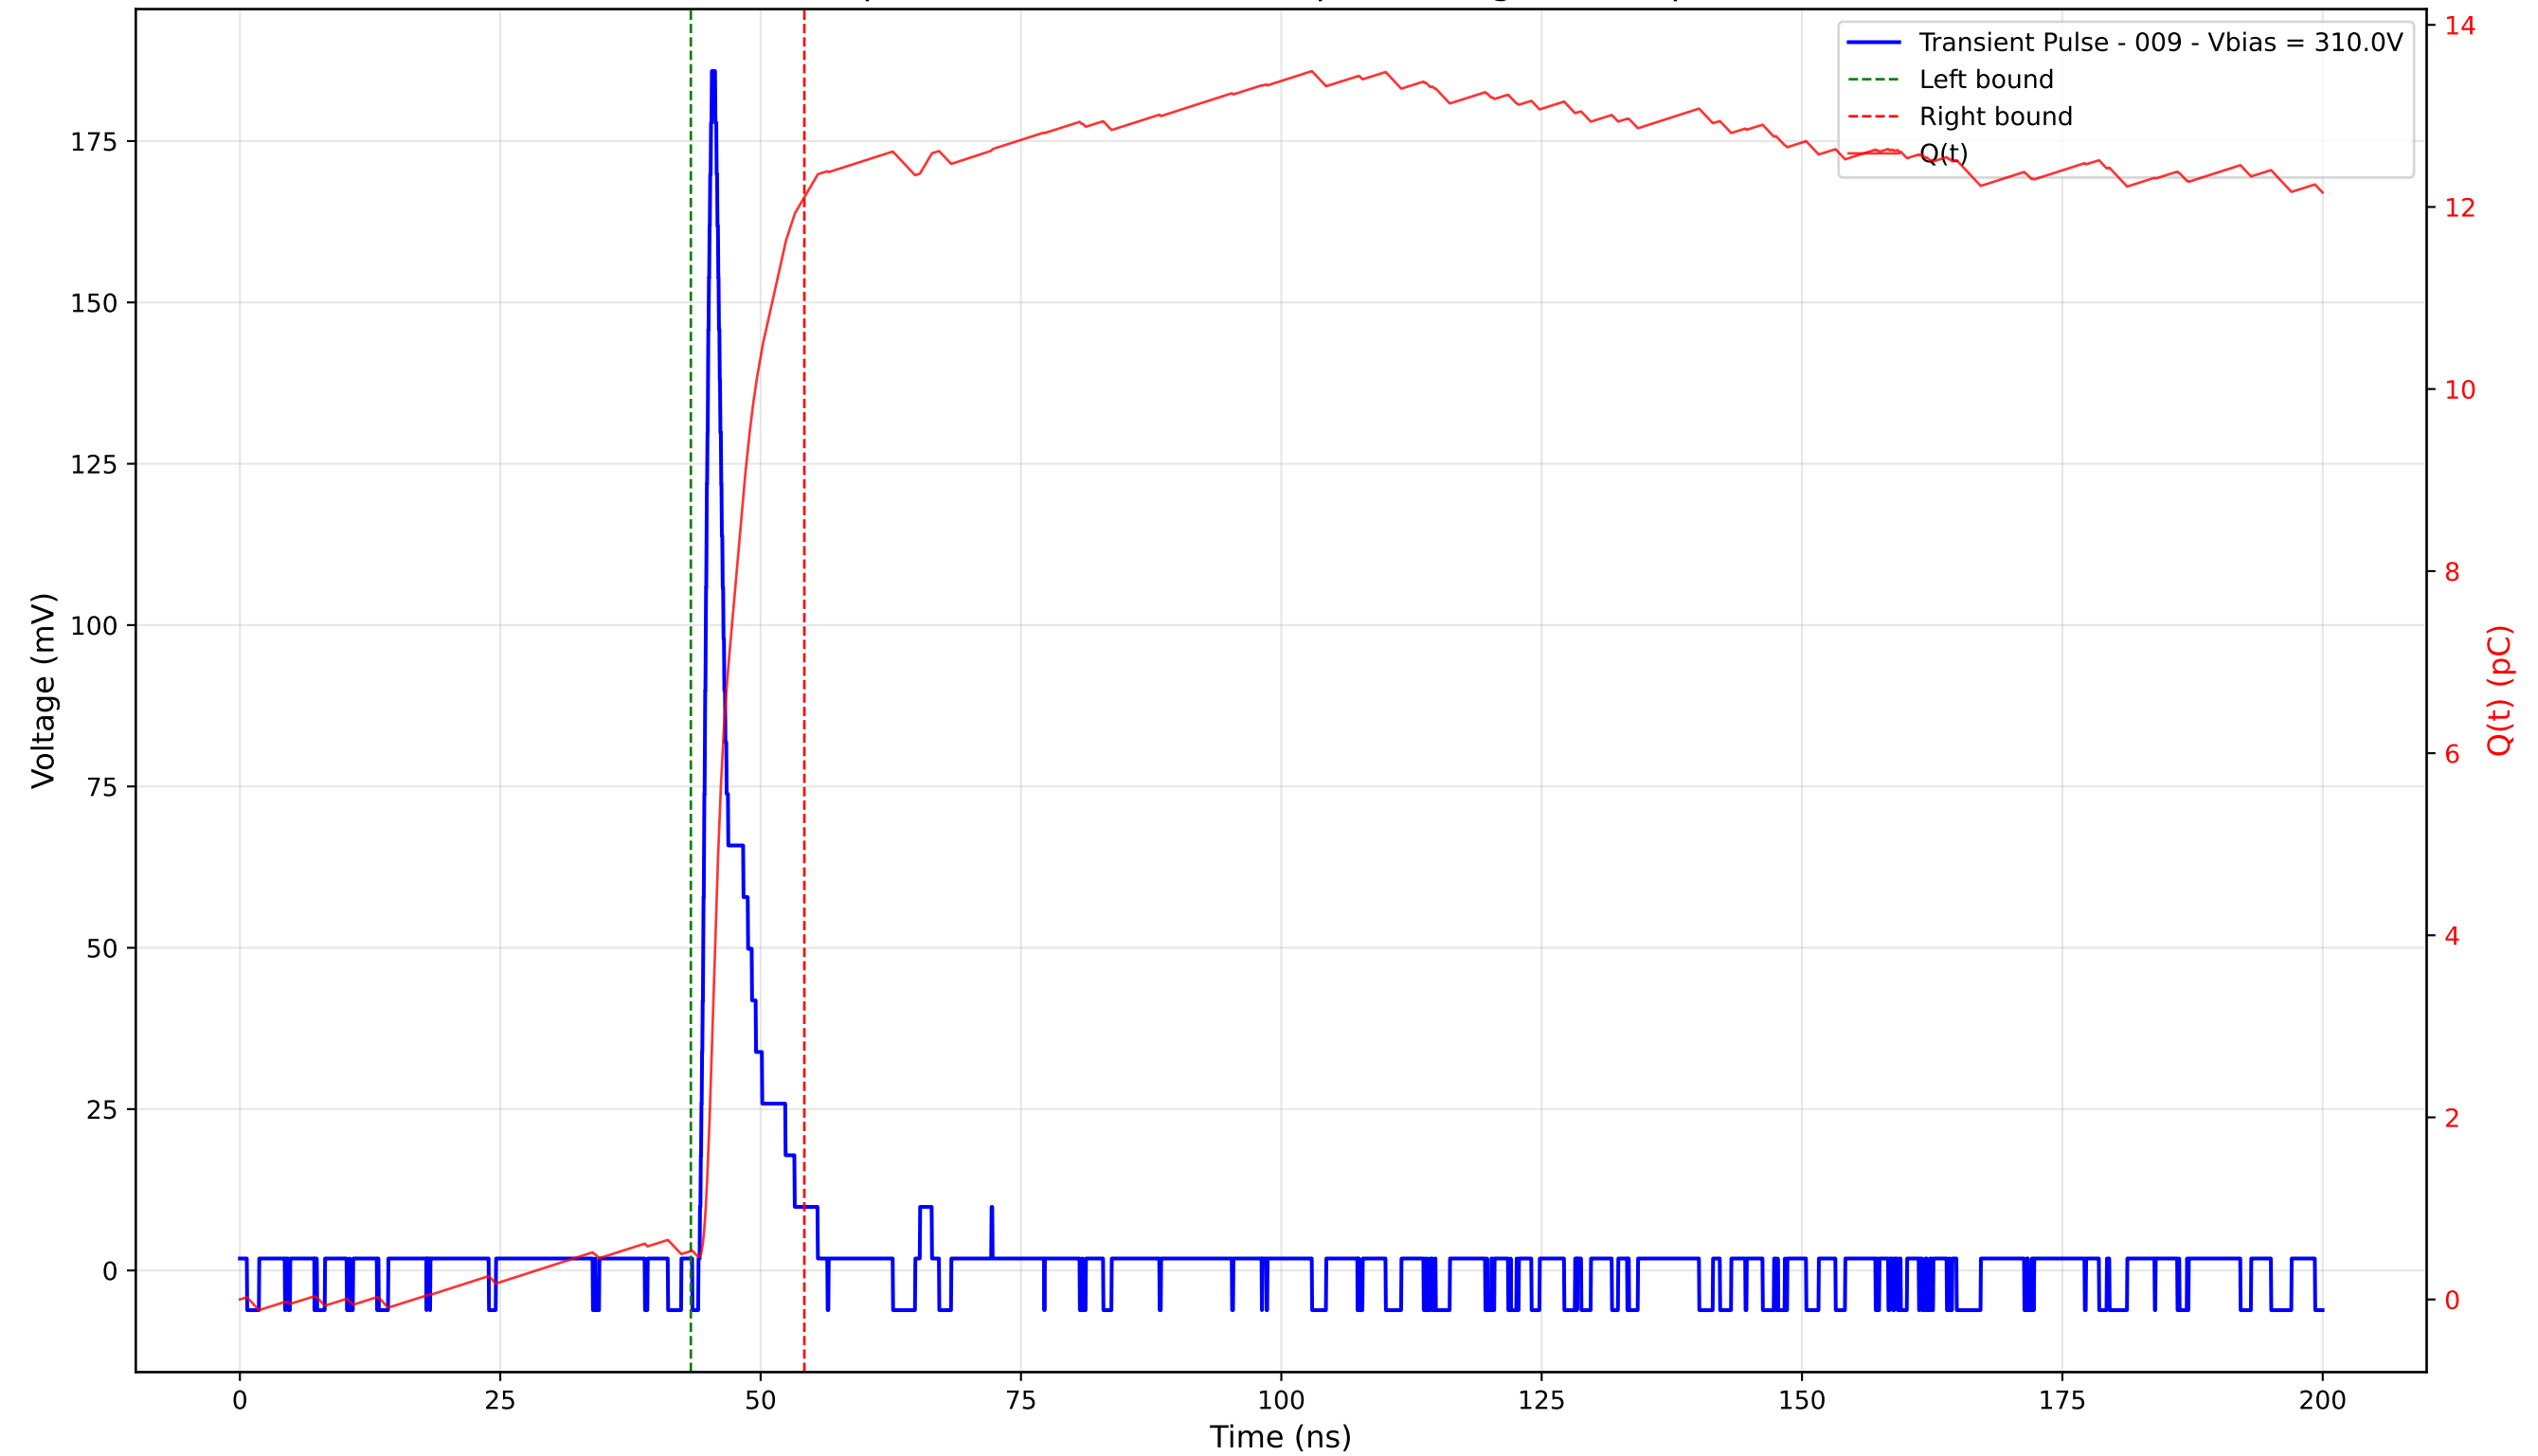


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 16.32 pC - Rise Time: 0.88 ns

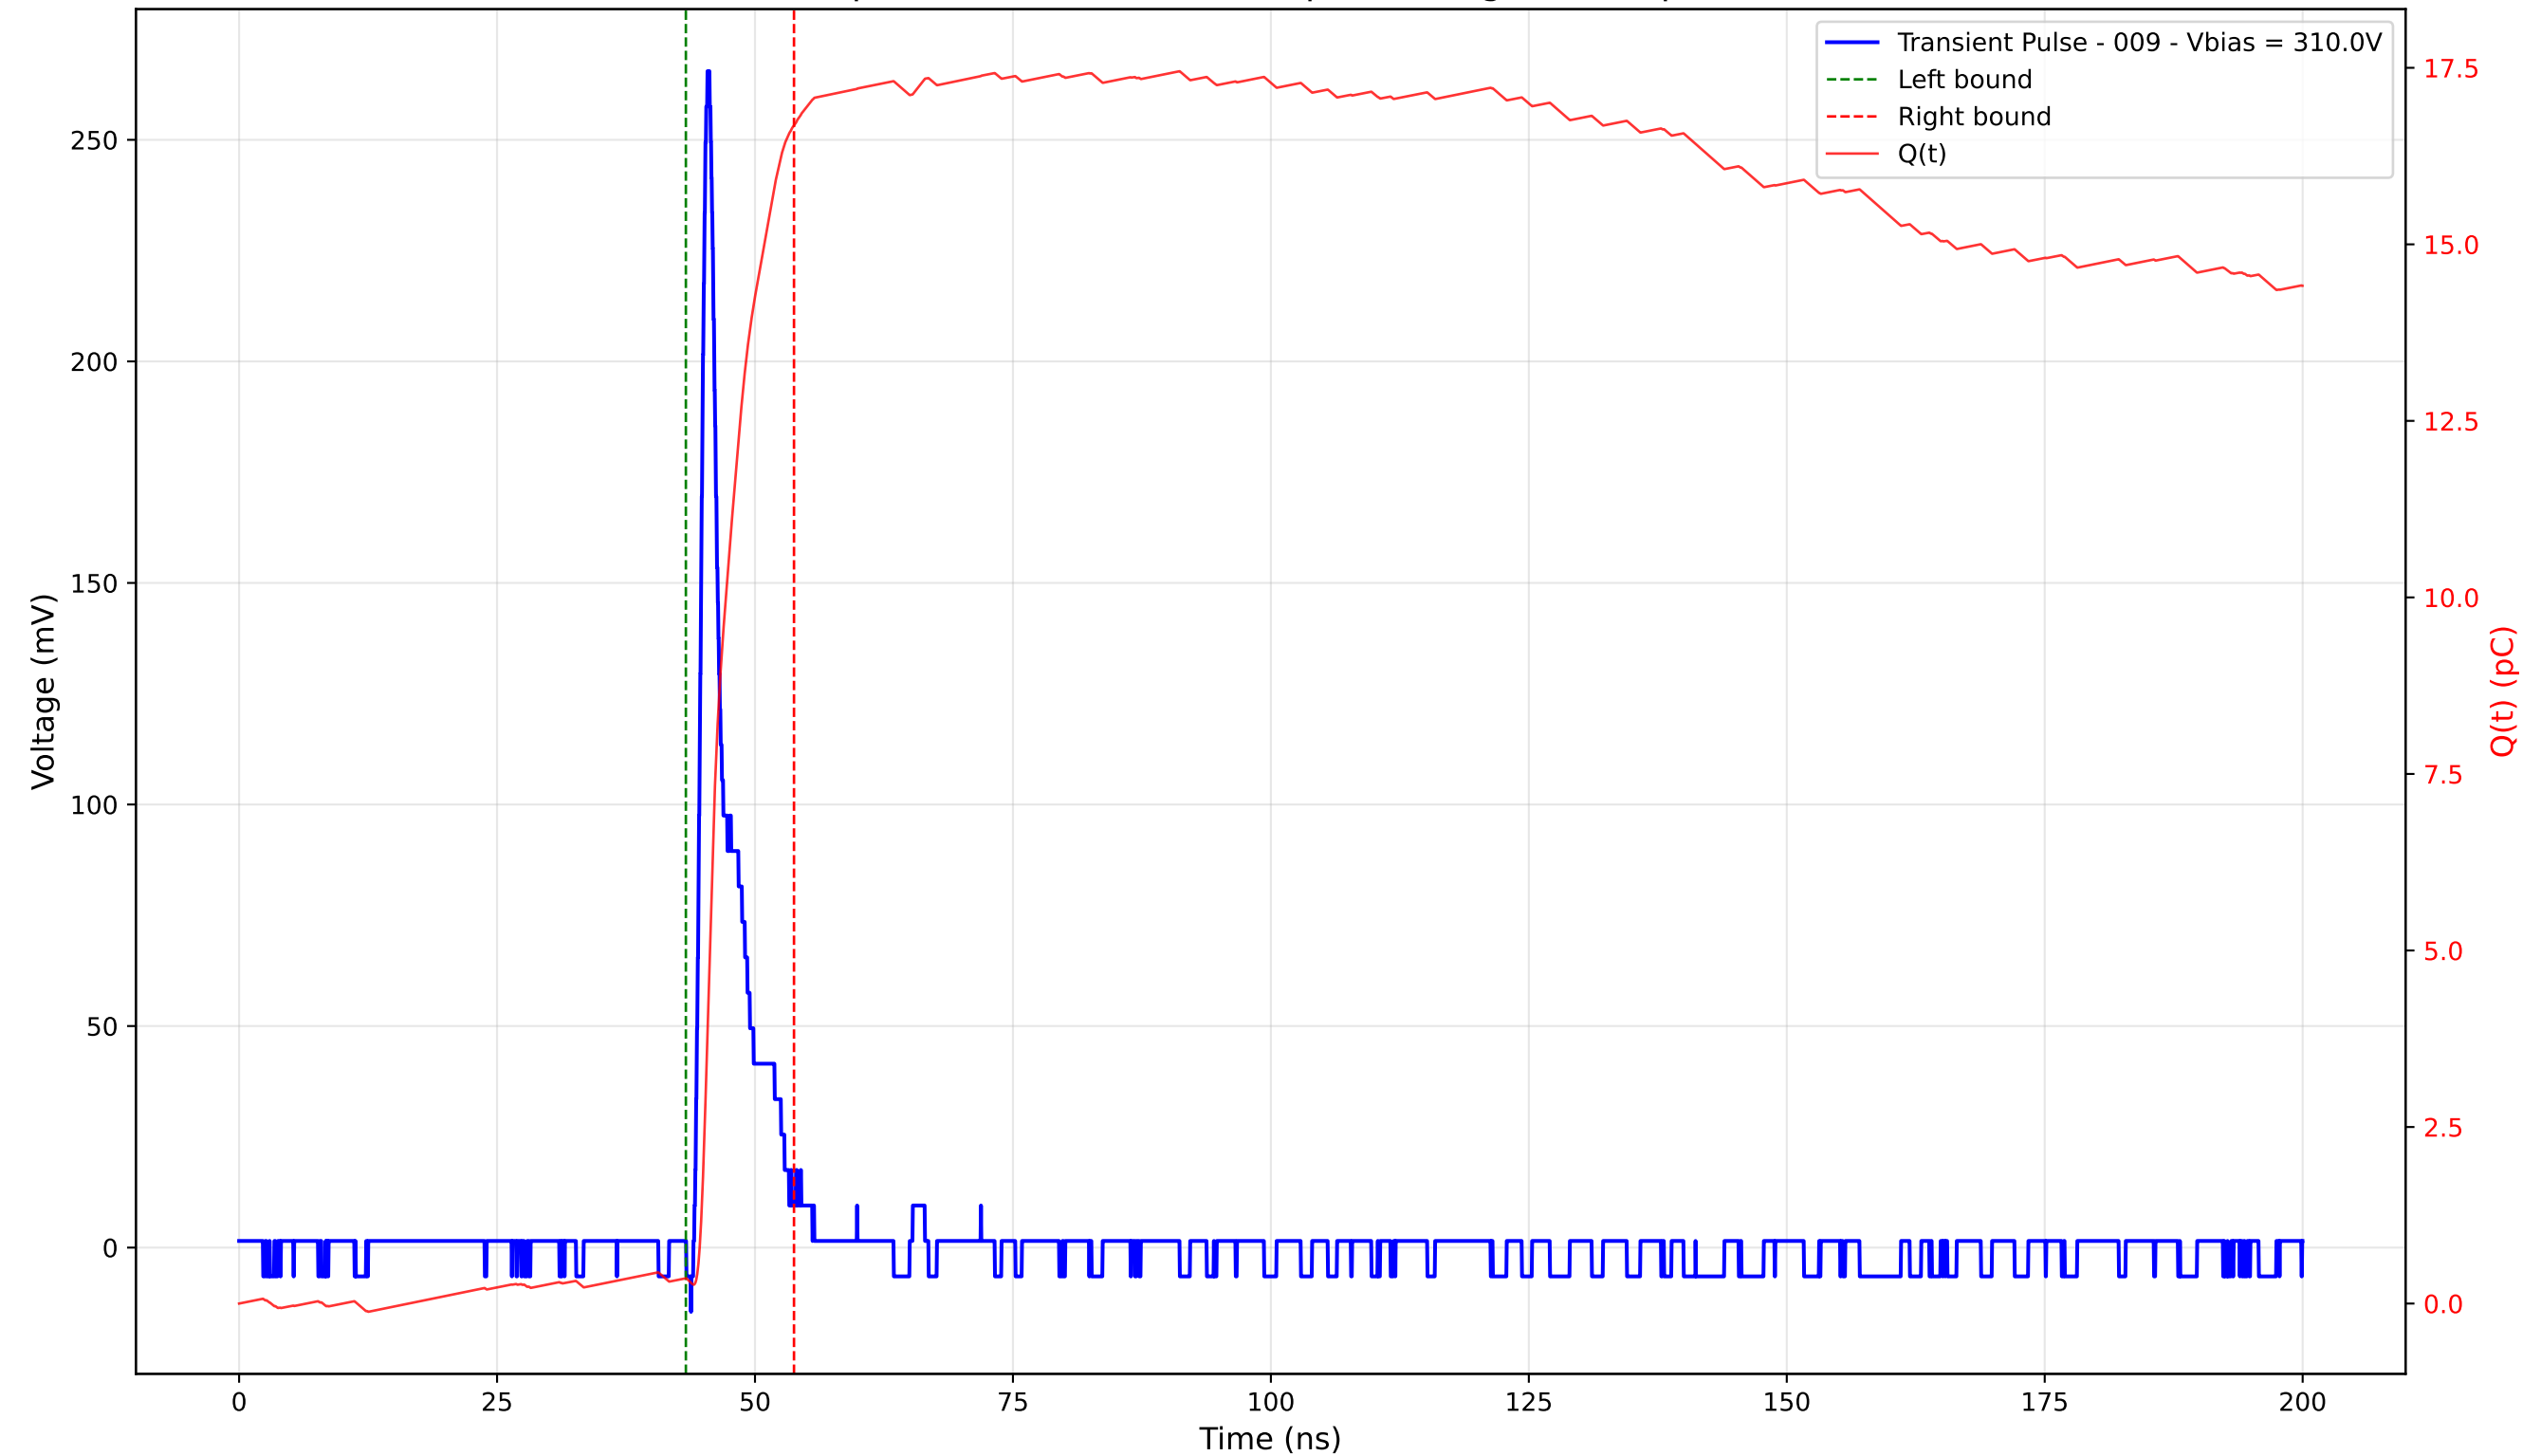


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 22.22 pC - Rise Time: 0.88 ns

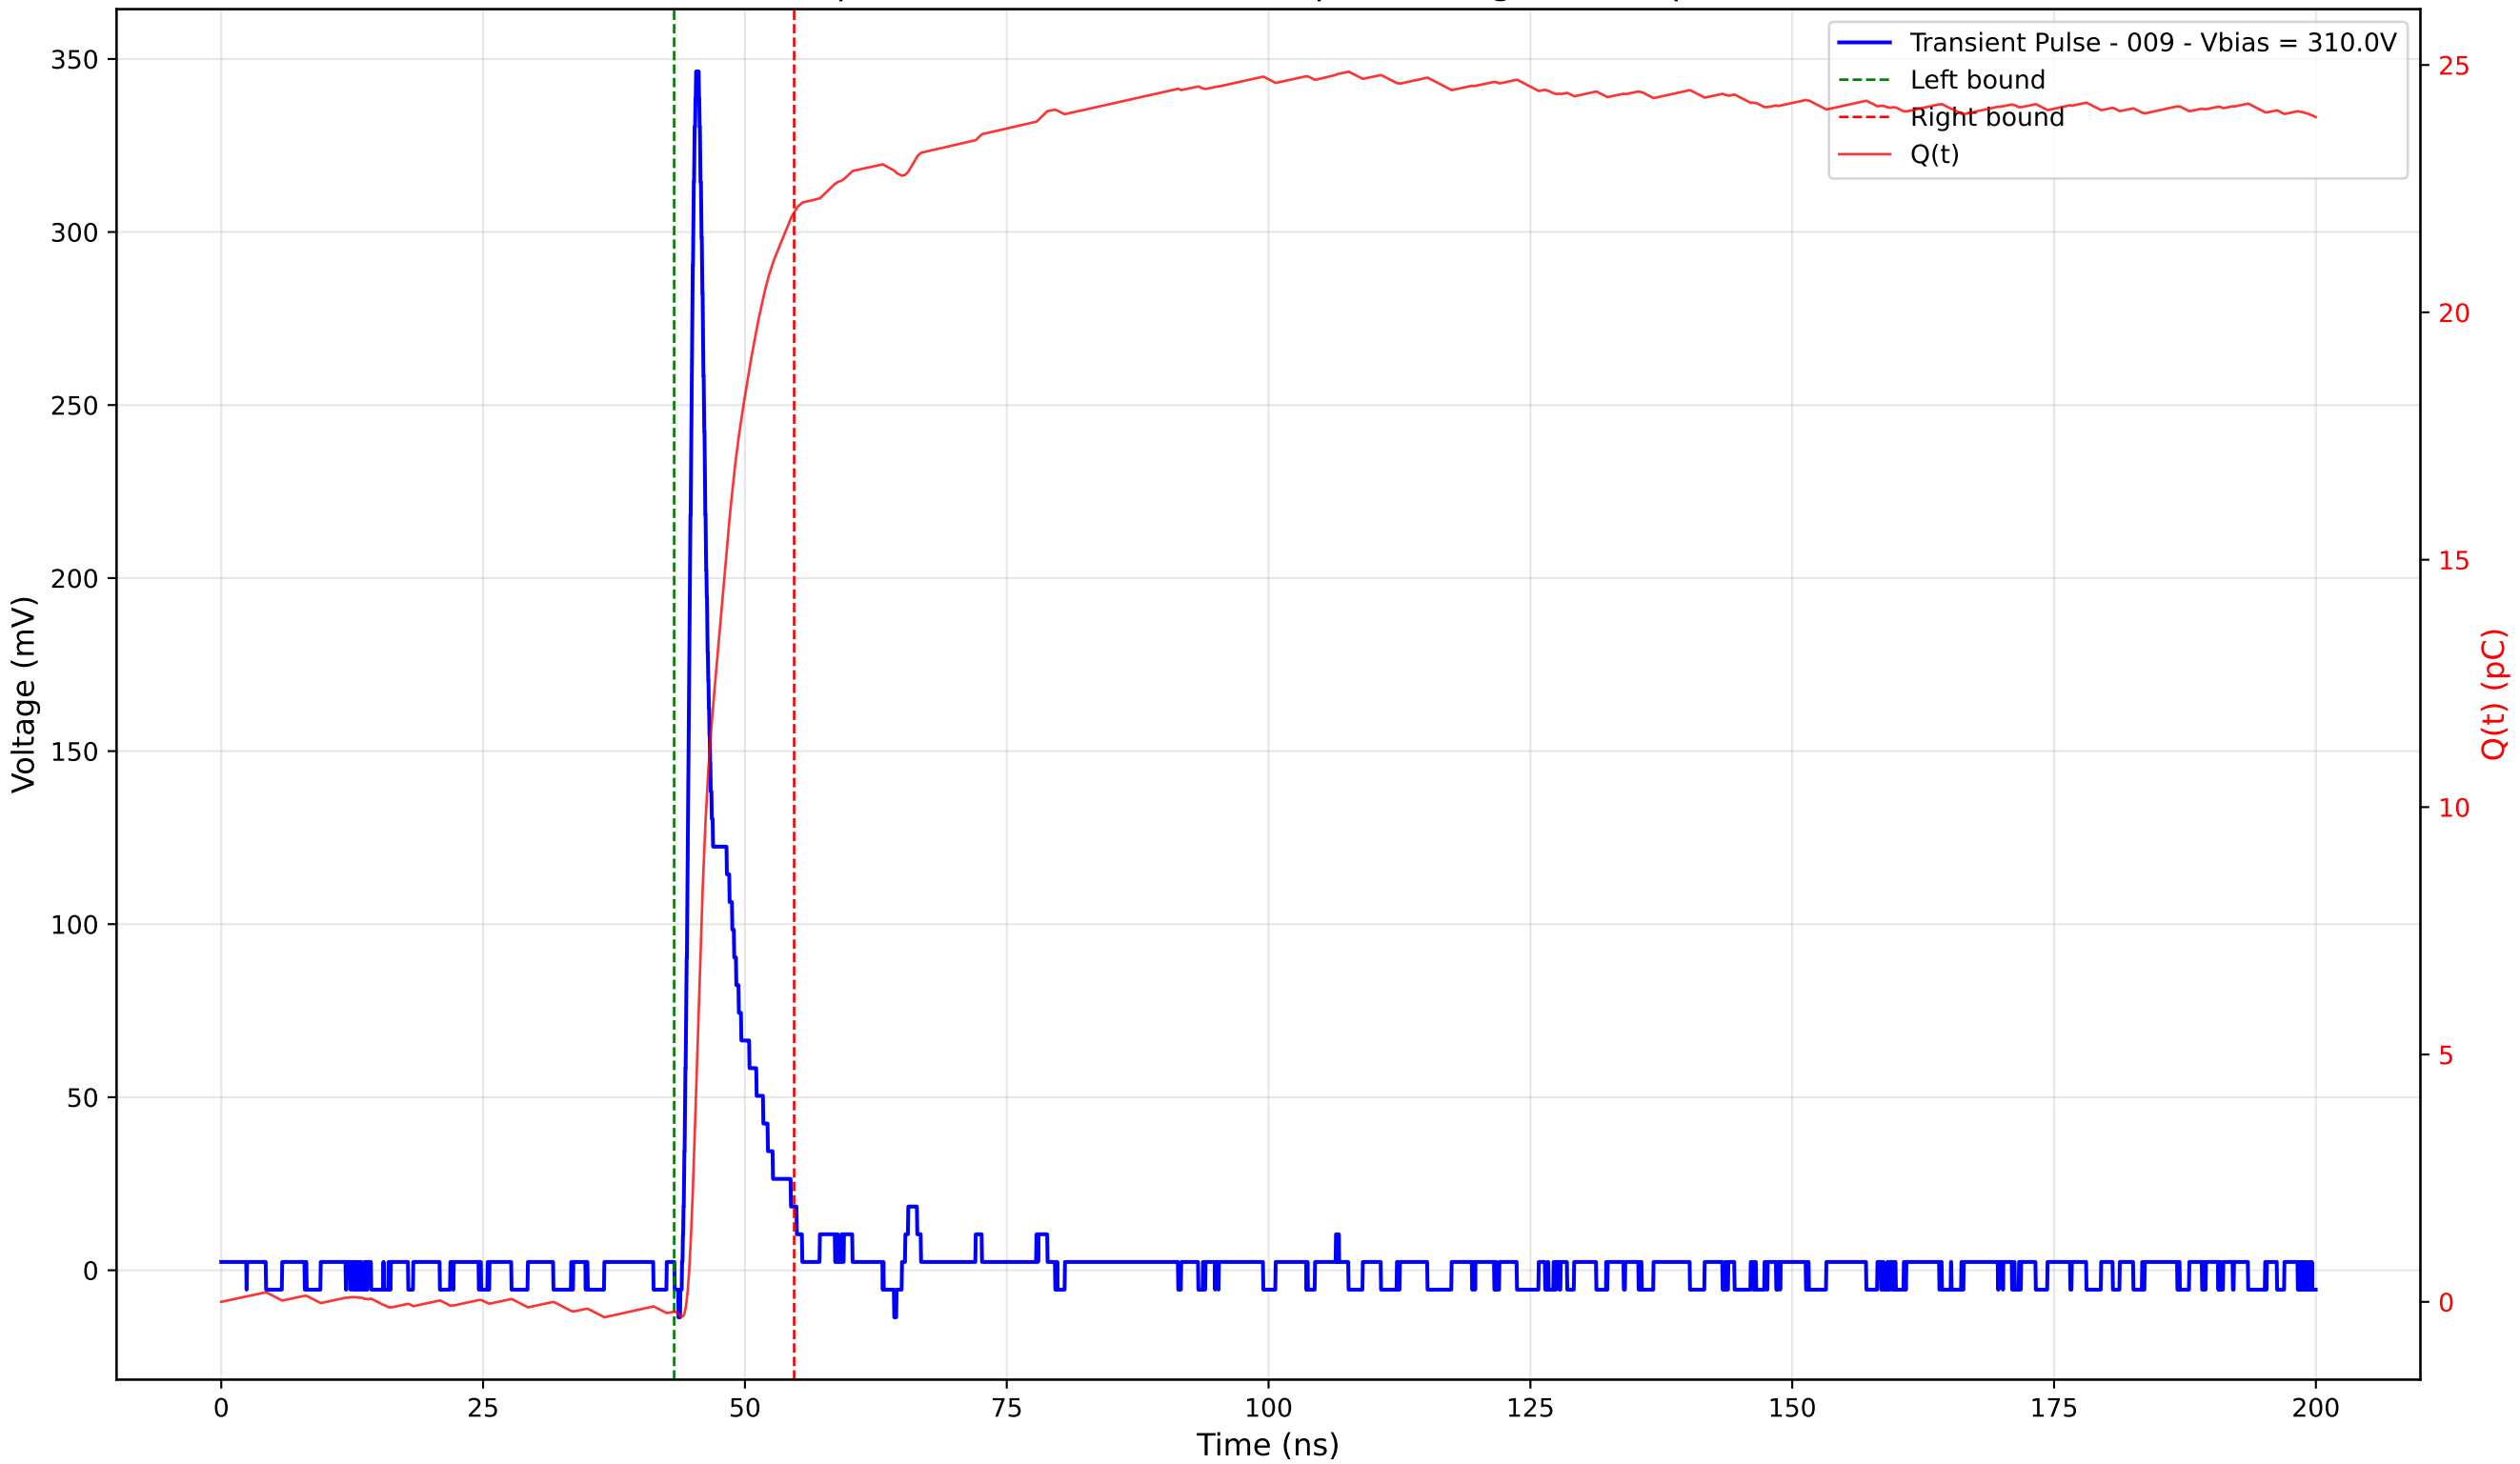


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 26.38 pC - Rise Time: 0.87 ns

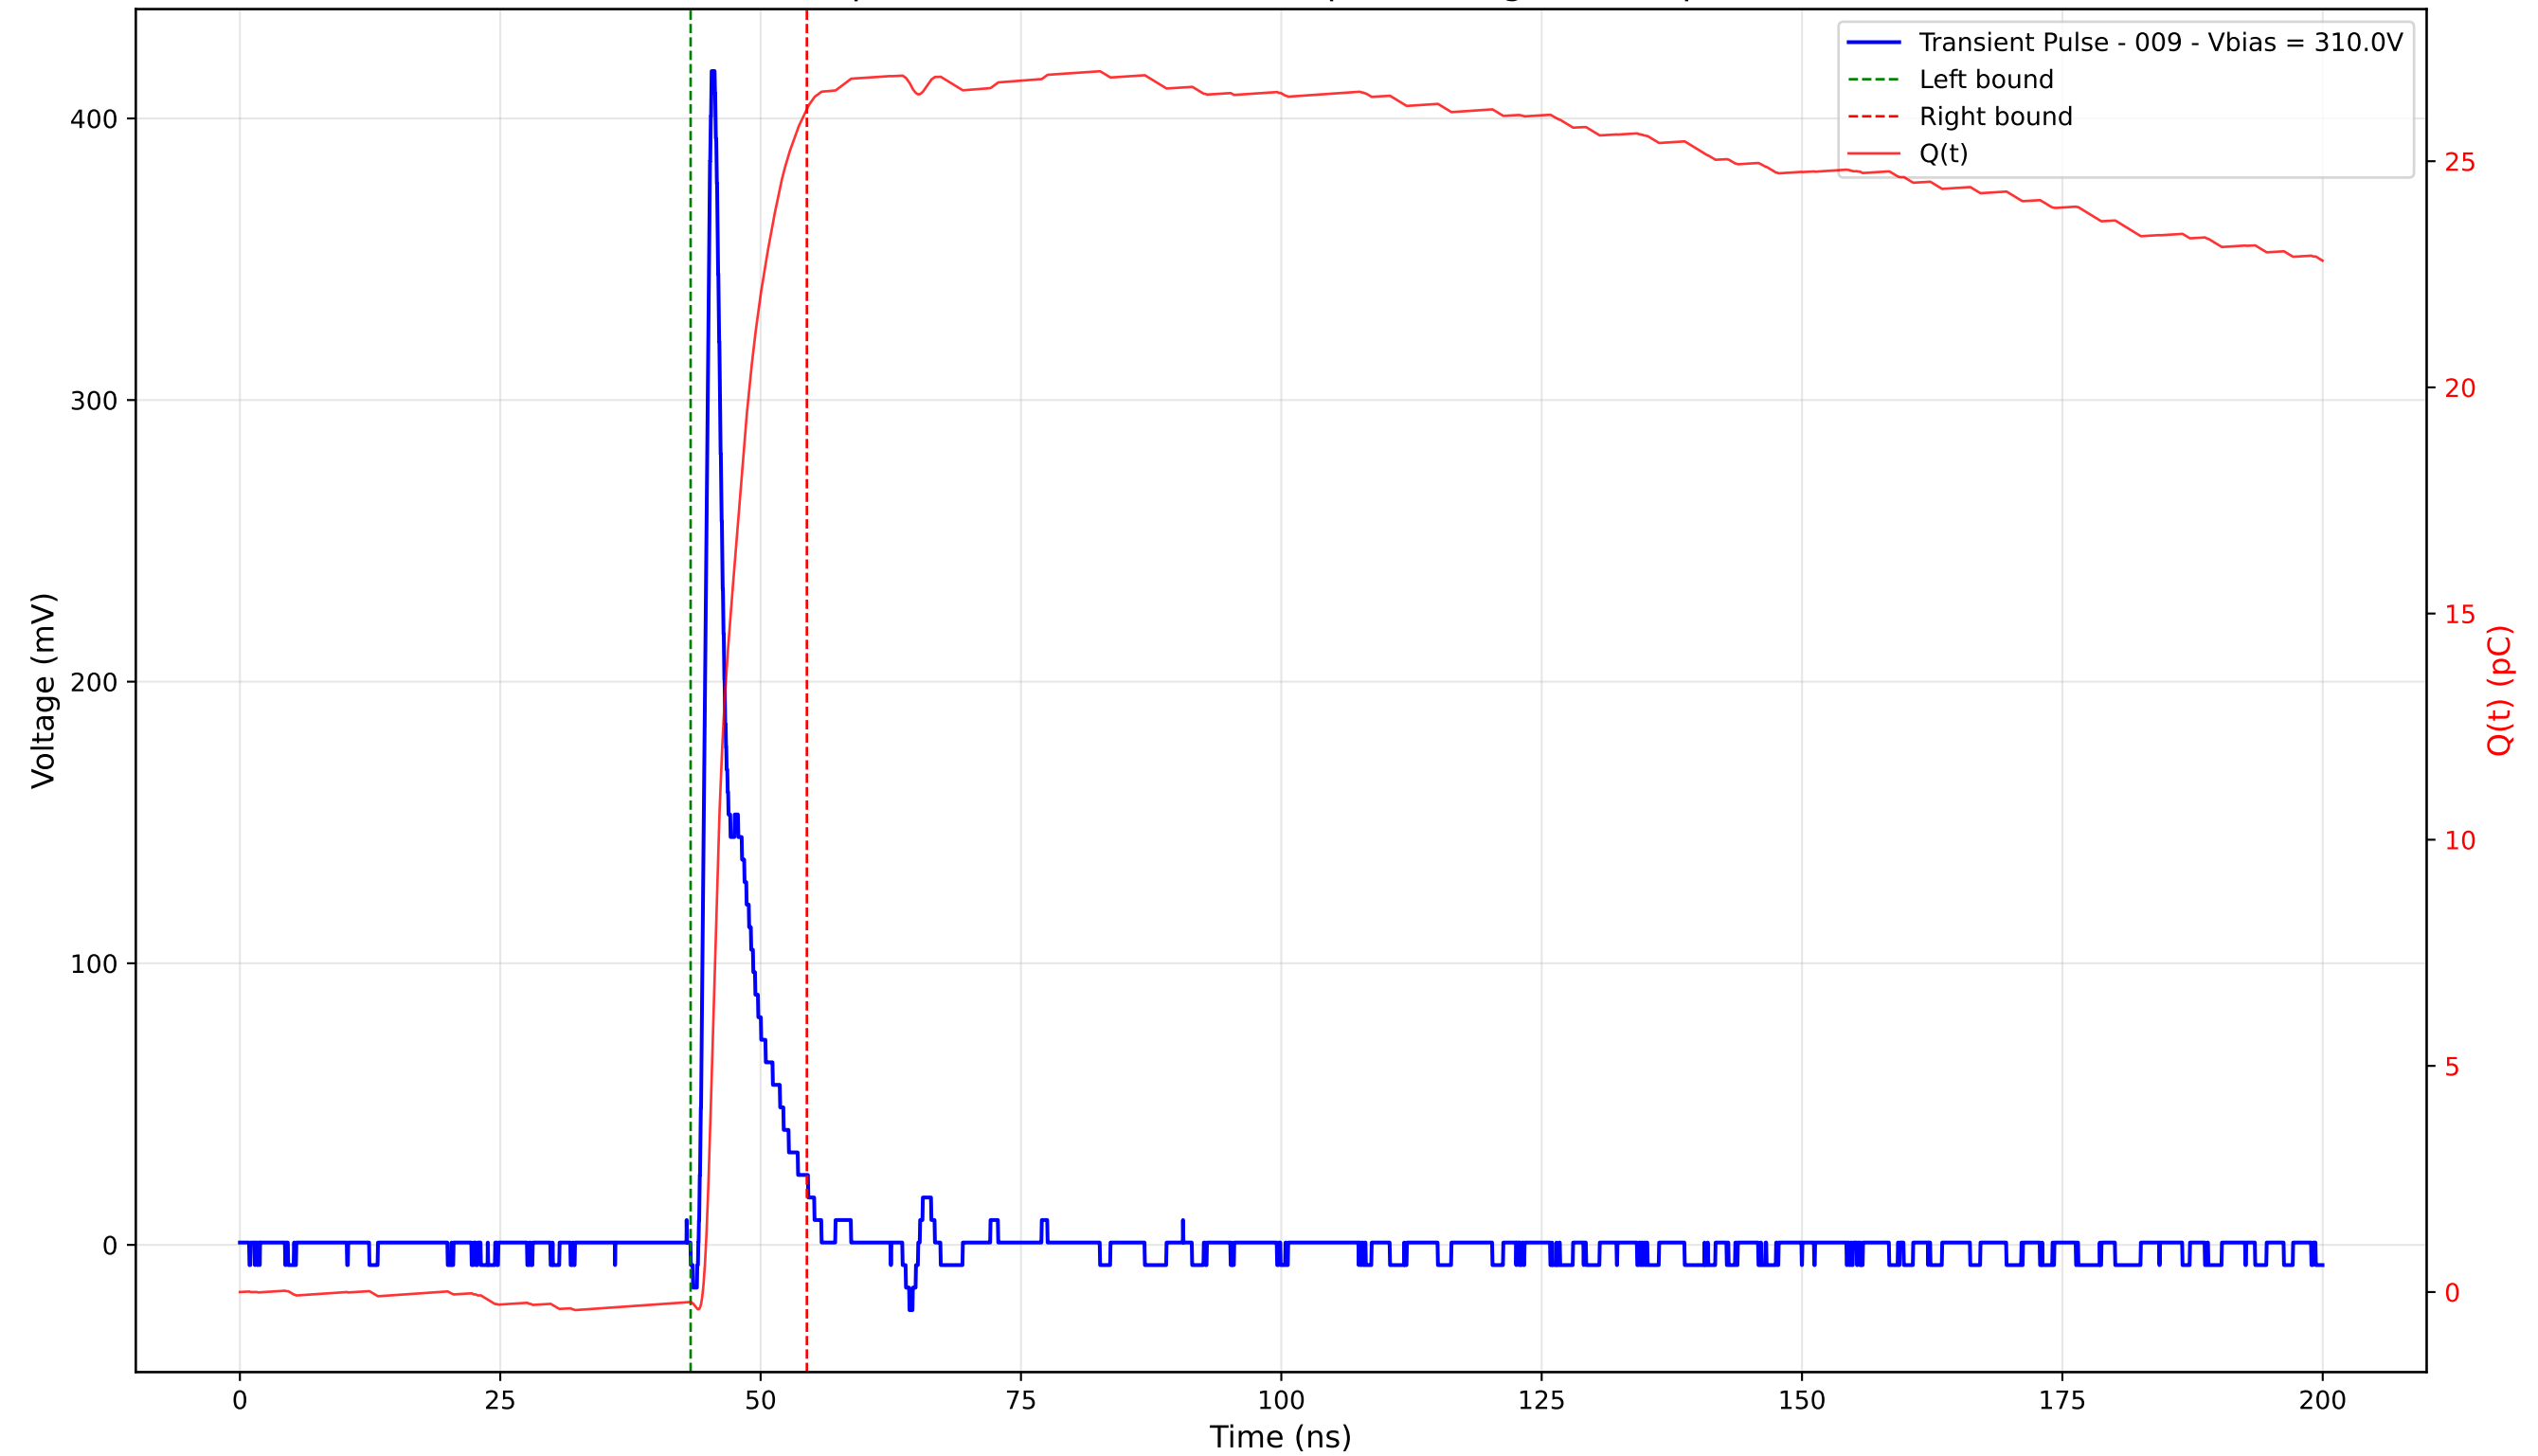


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 31.52 pC - Rise Time: 0.89 ns

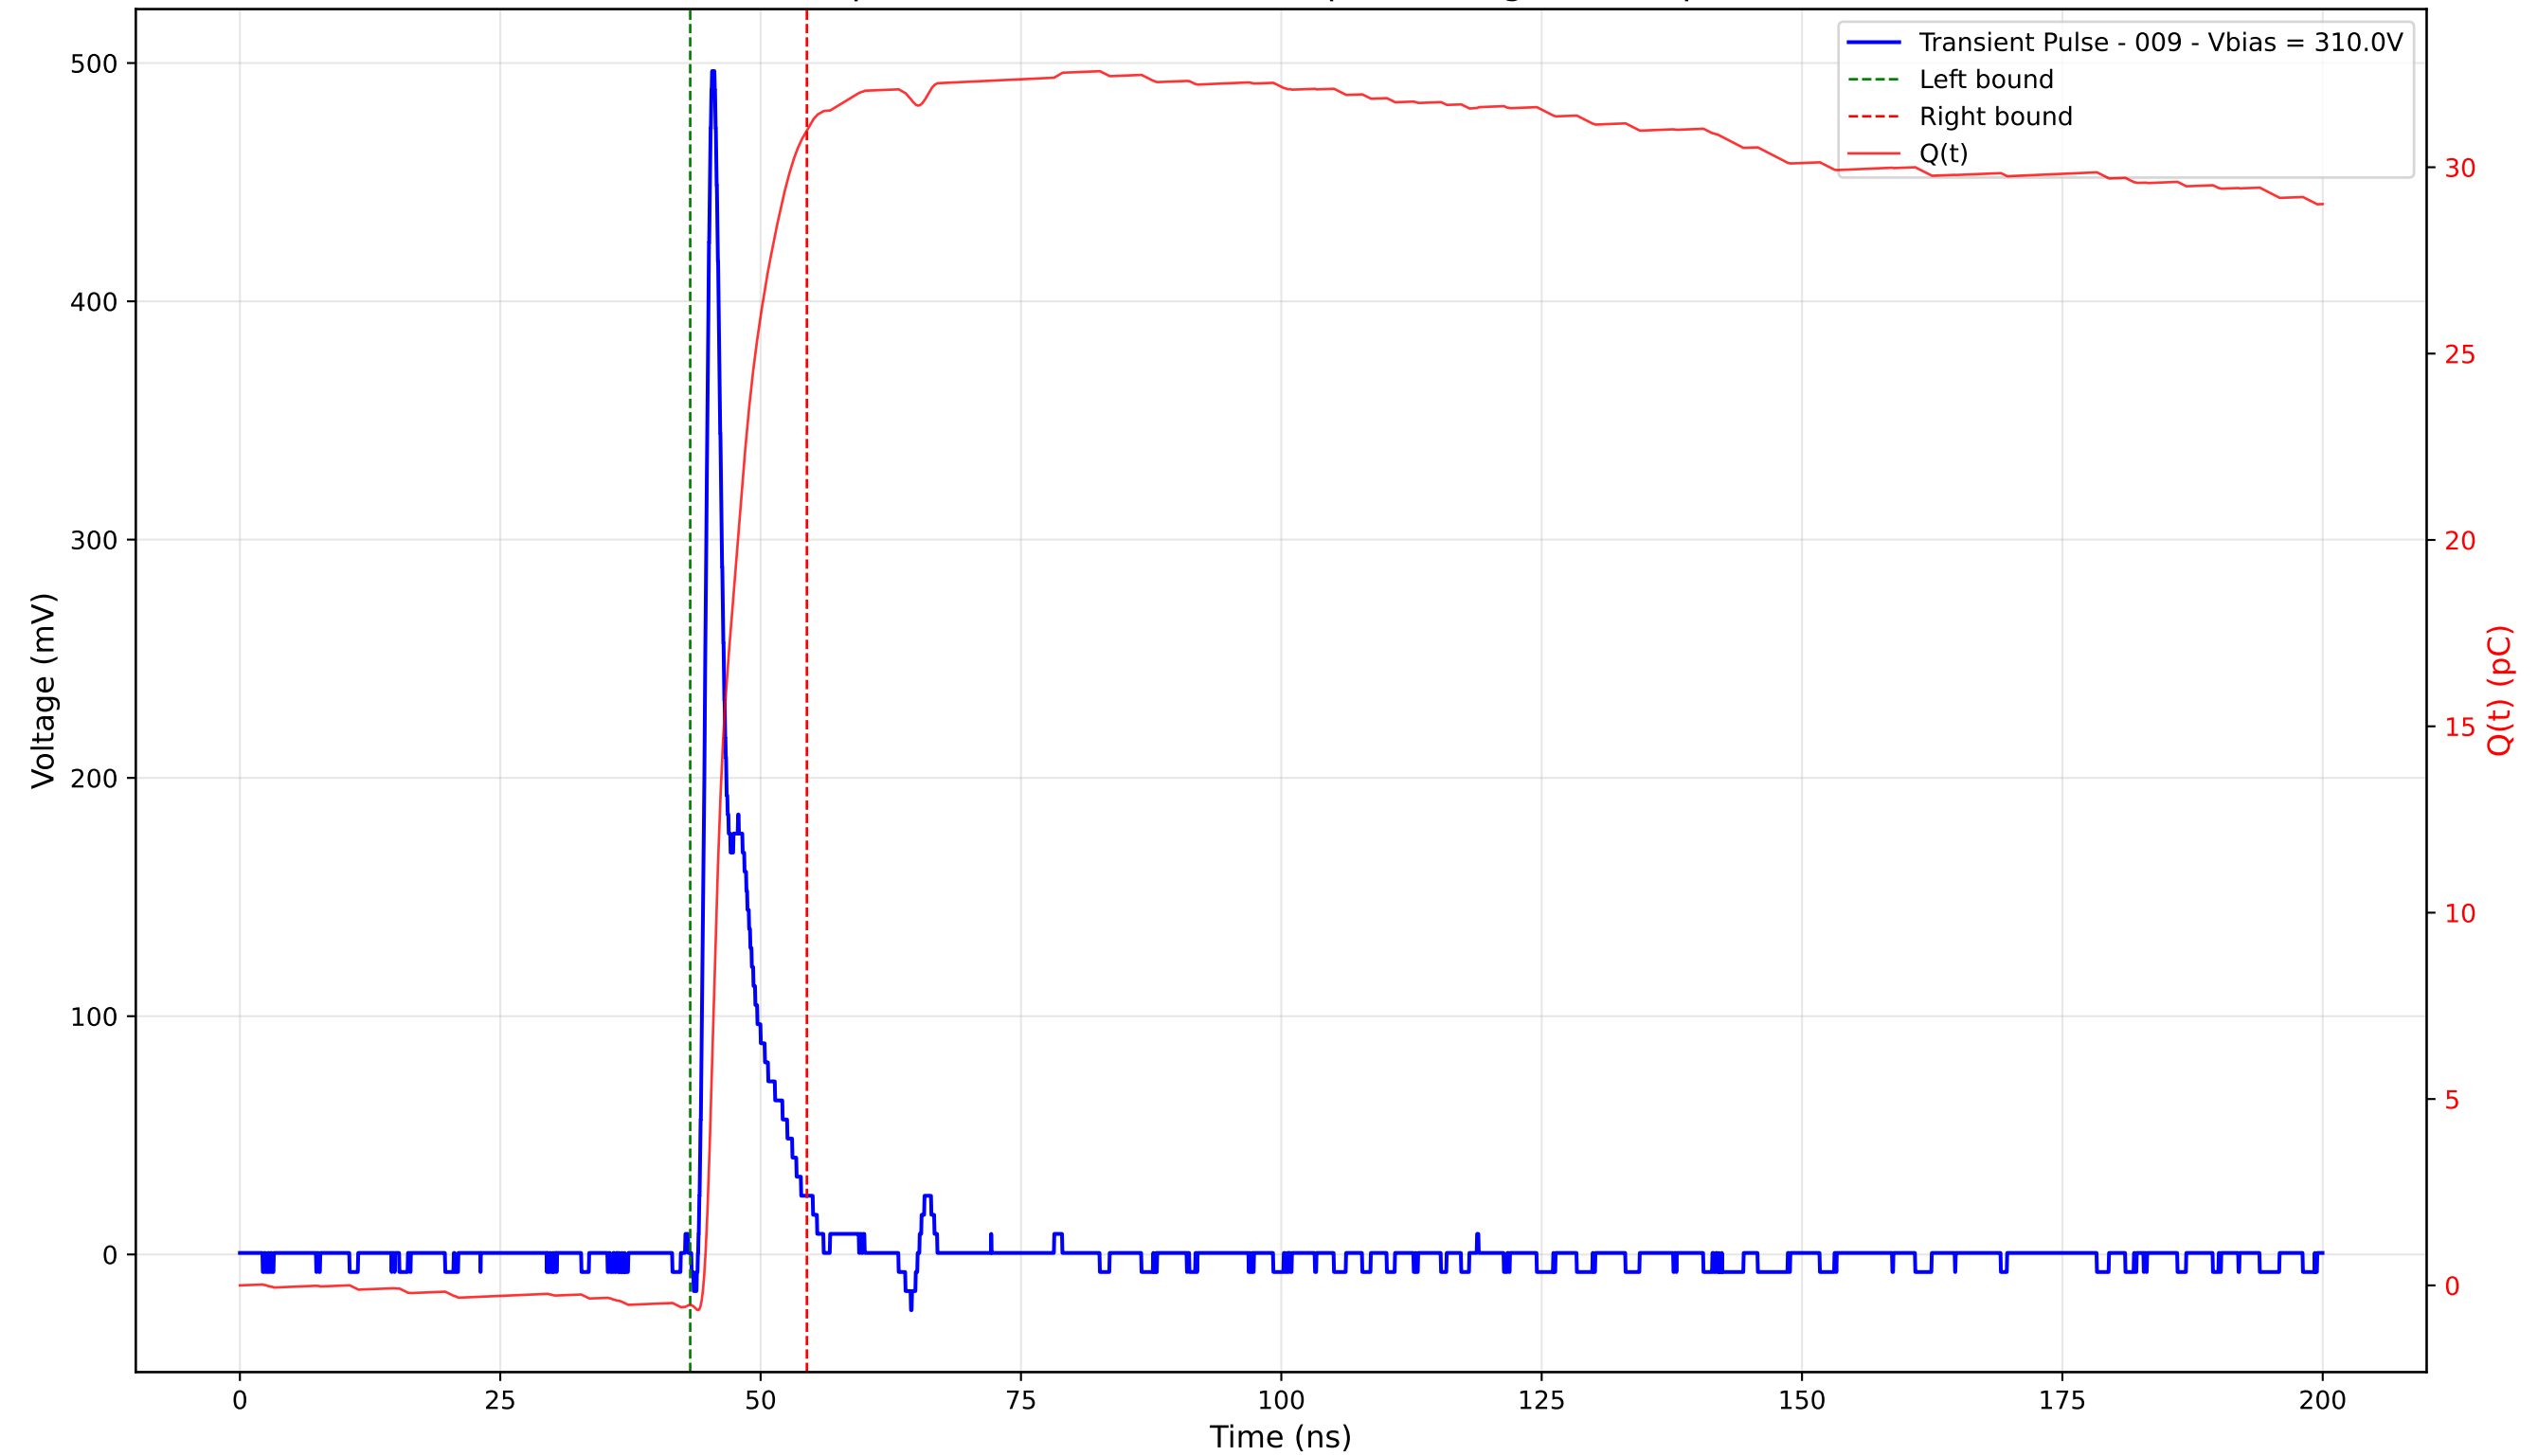


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 33.45 pC - Rise Time: 0.89 ns

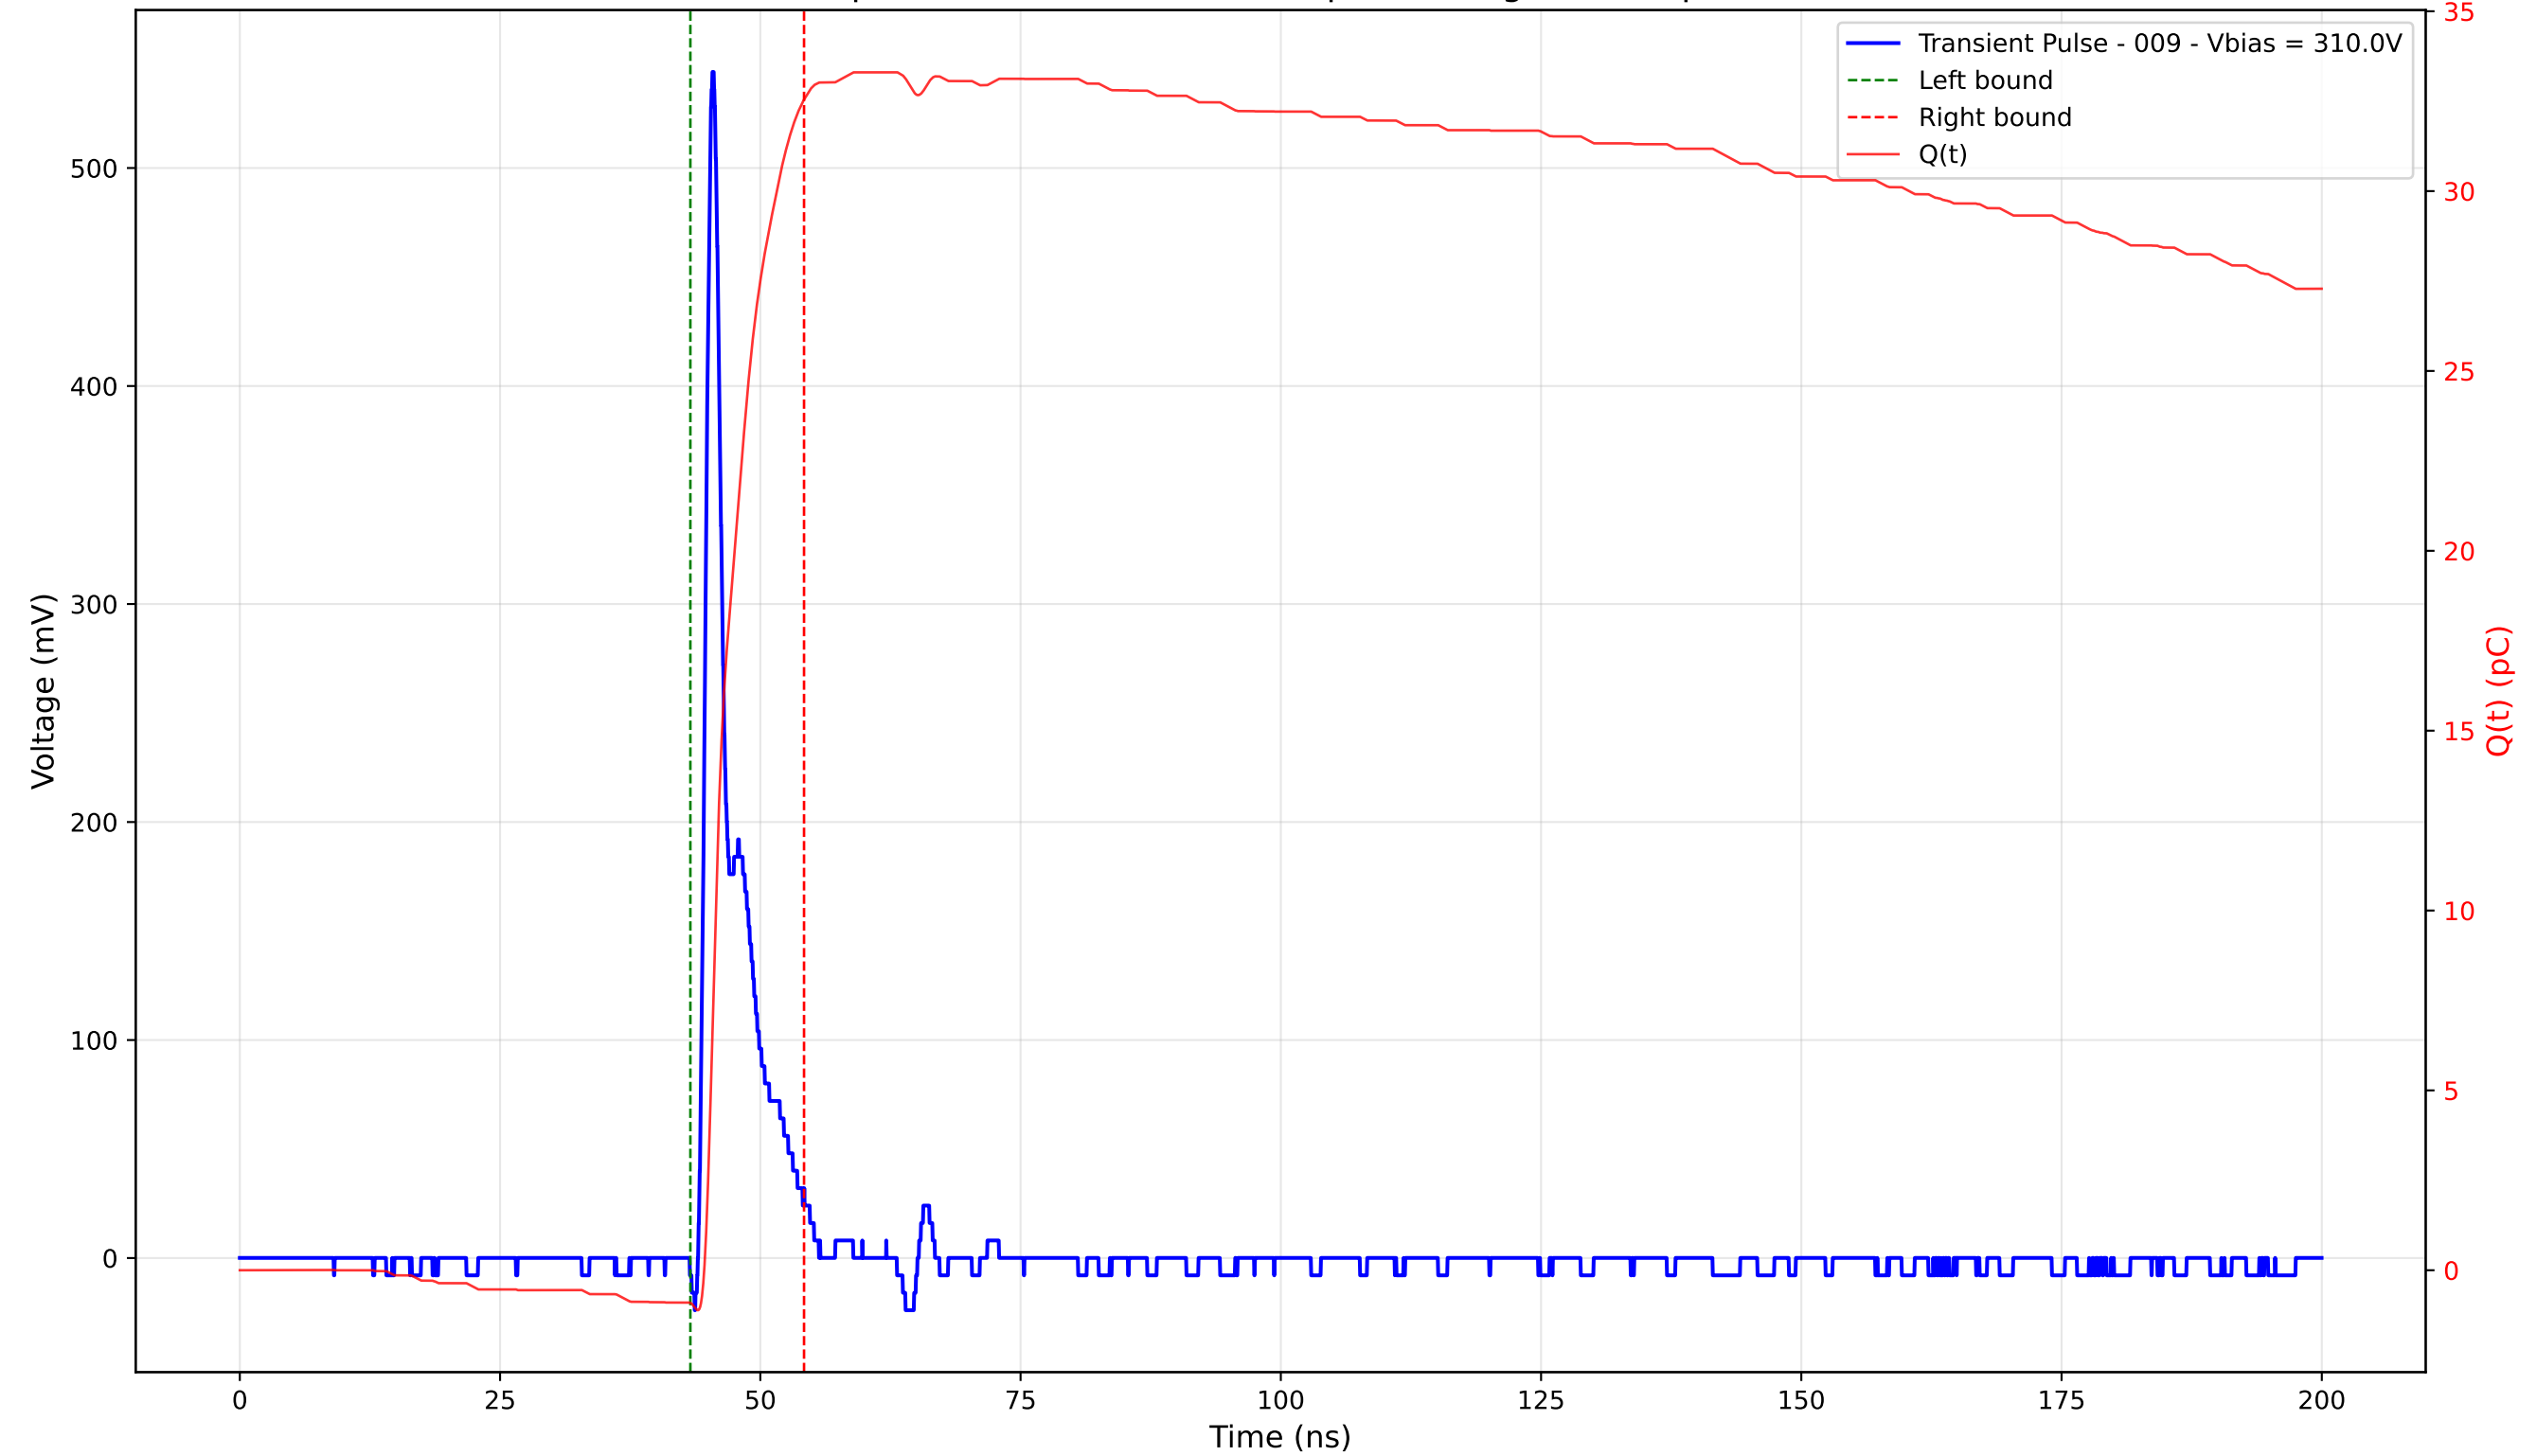


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 36.05 pC - Rise Time: 0.90 ns

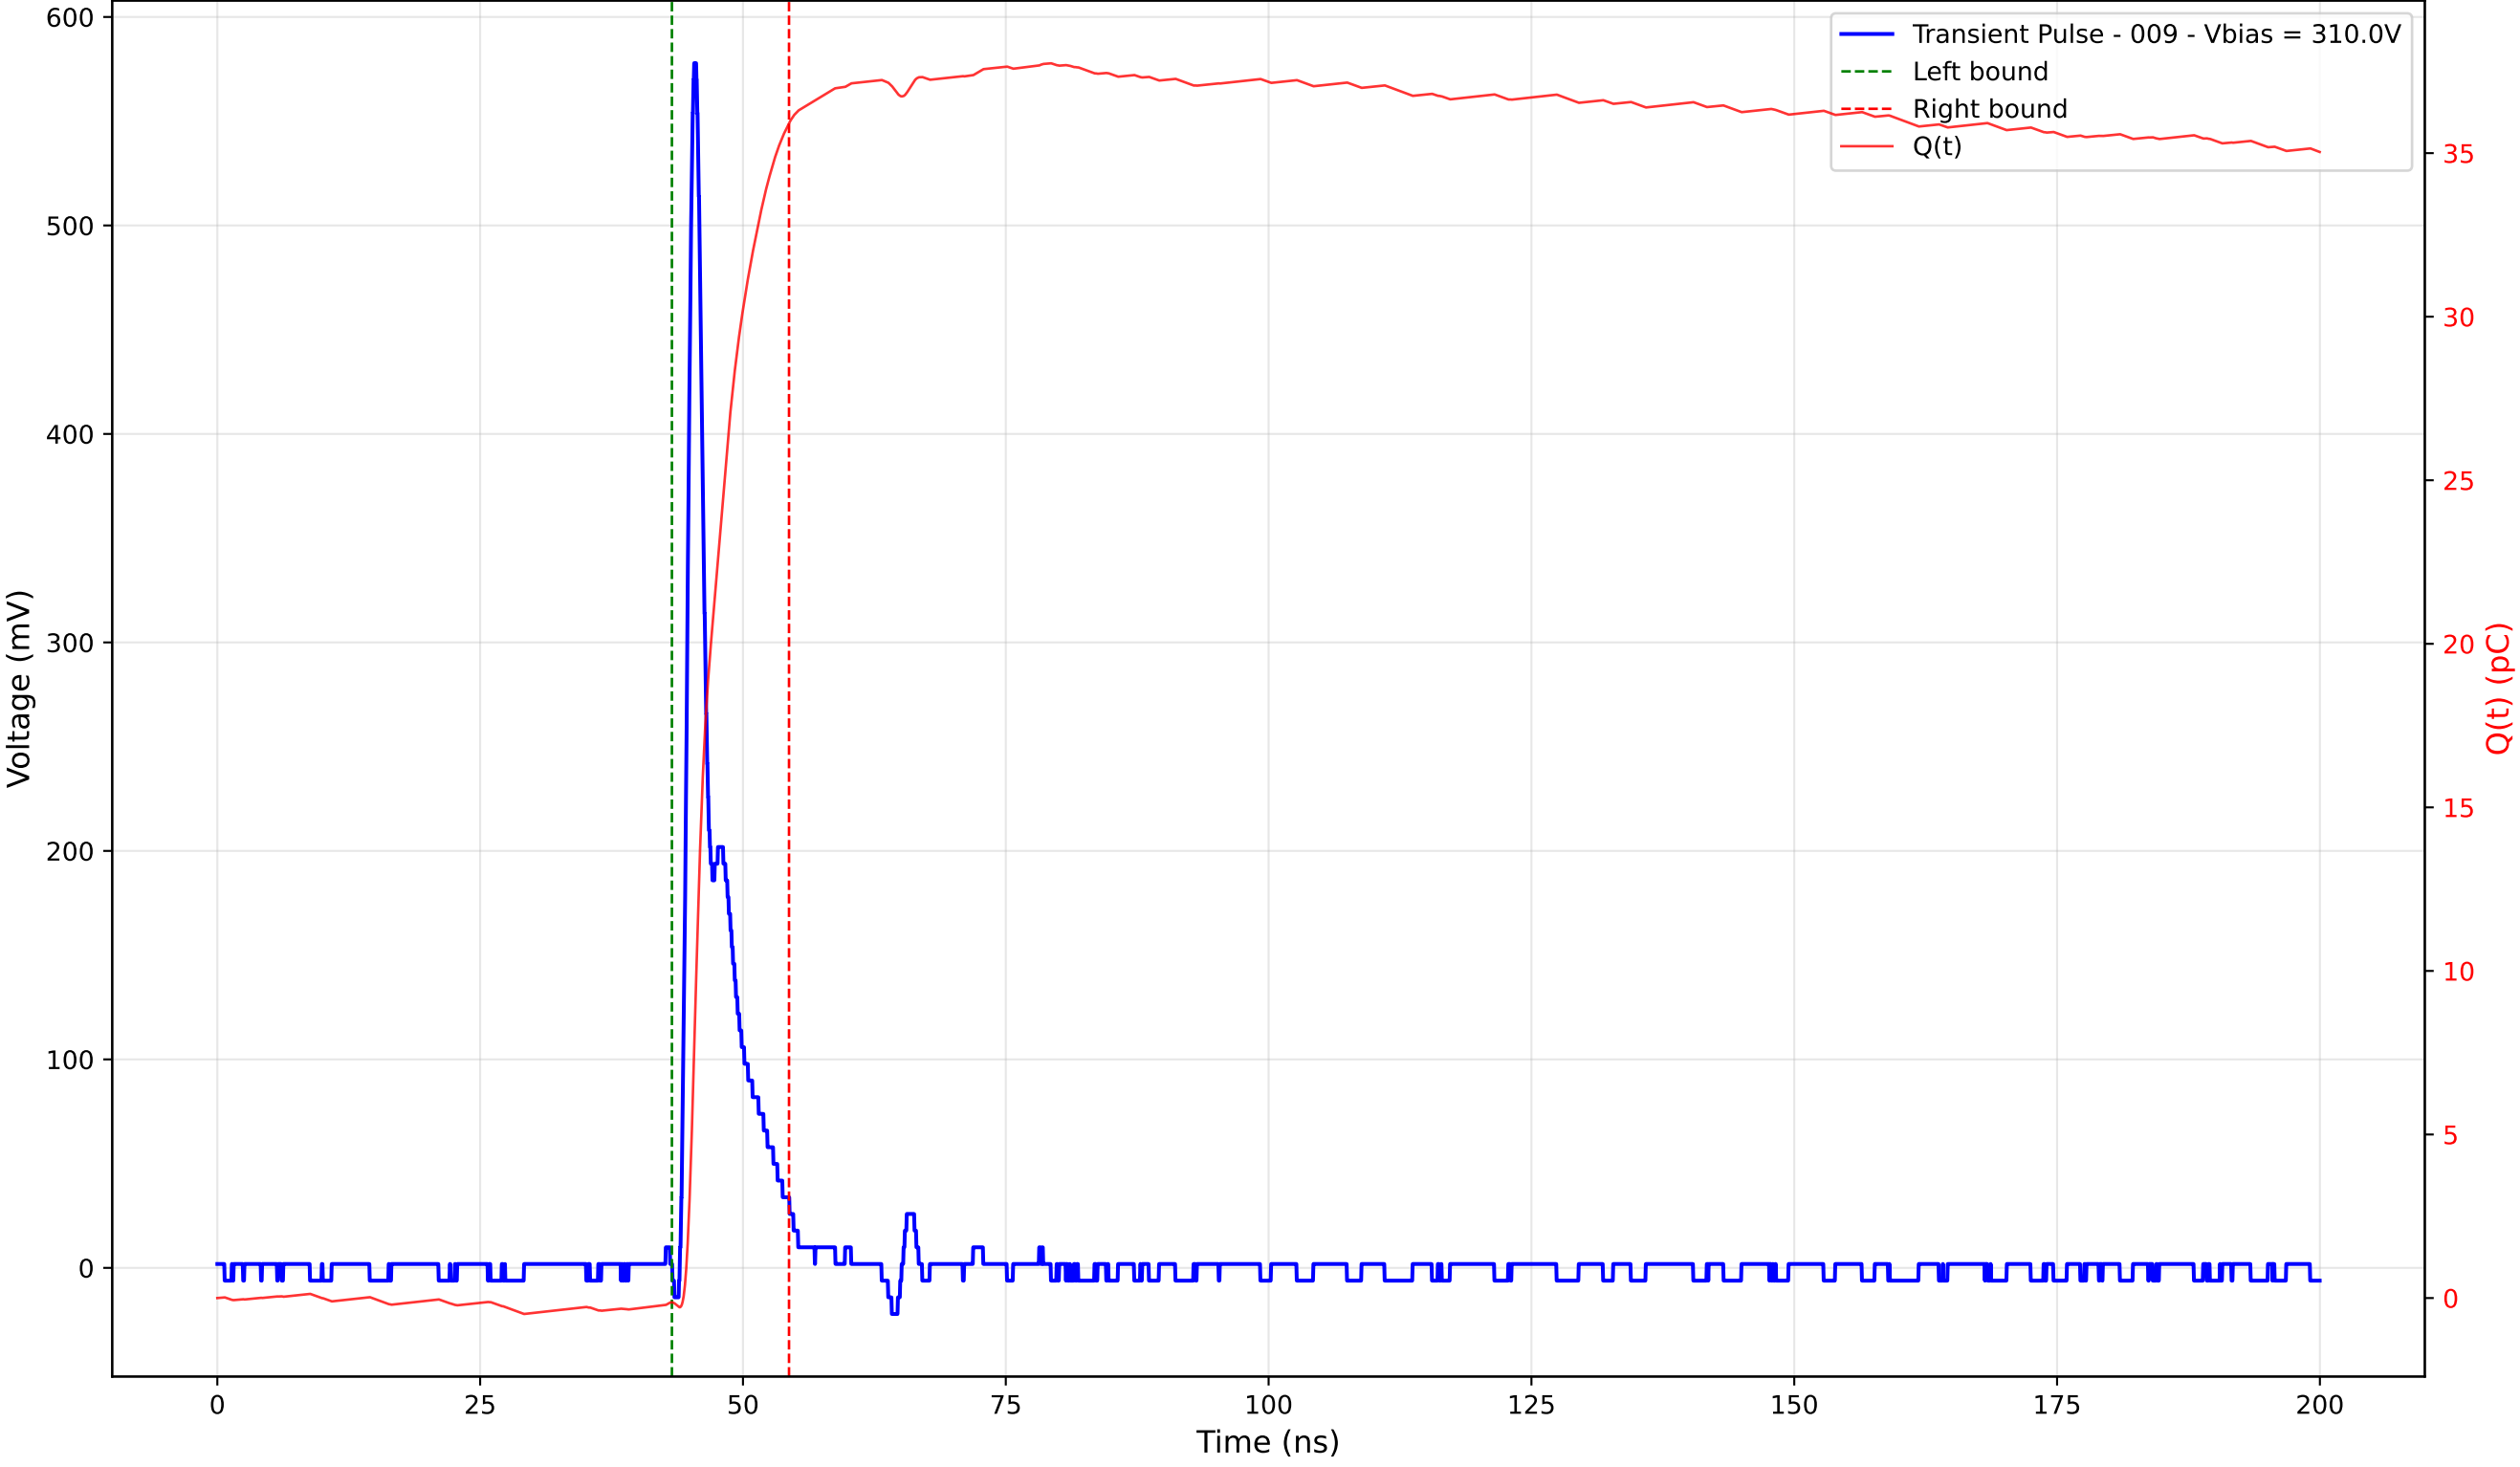


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 36.52 pC - Rise Time: 0.89 ns

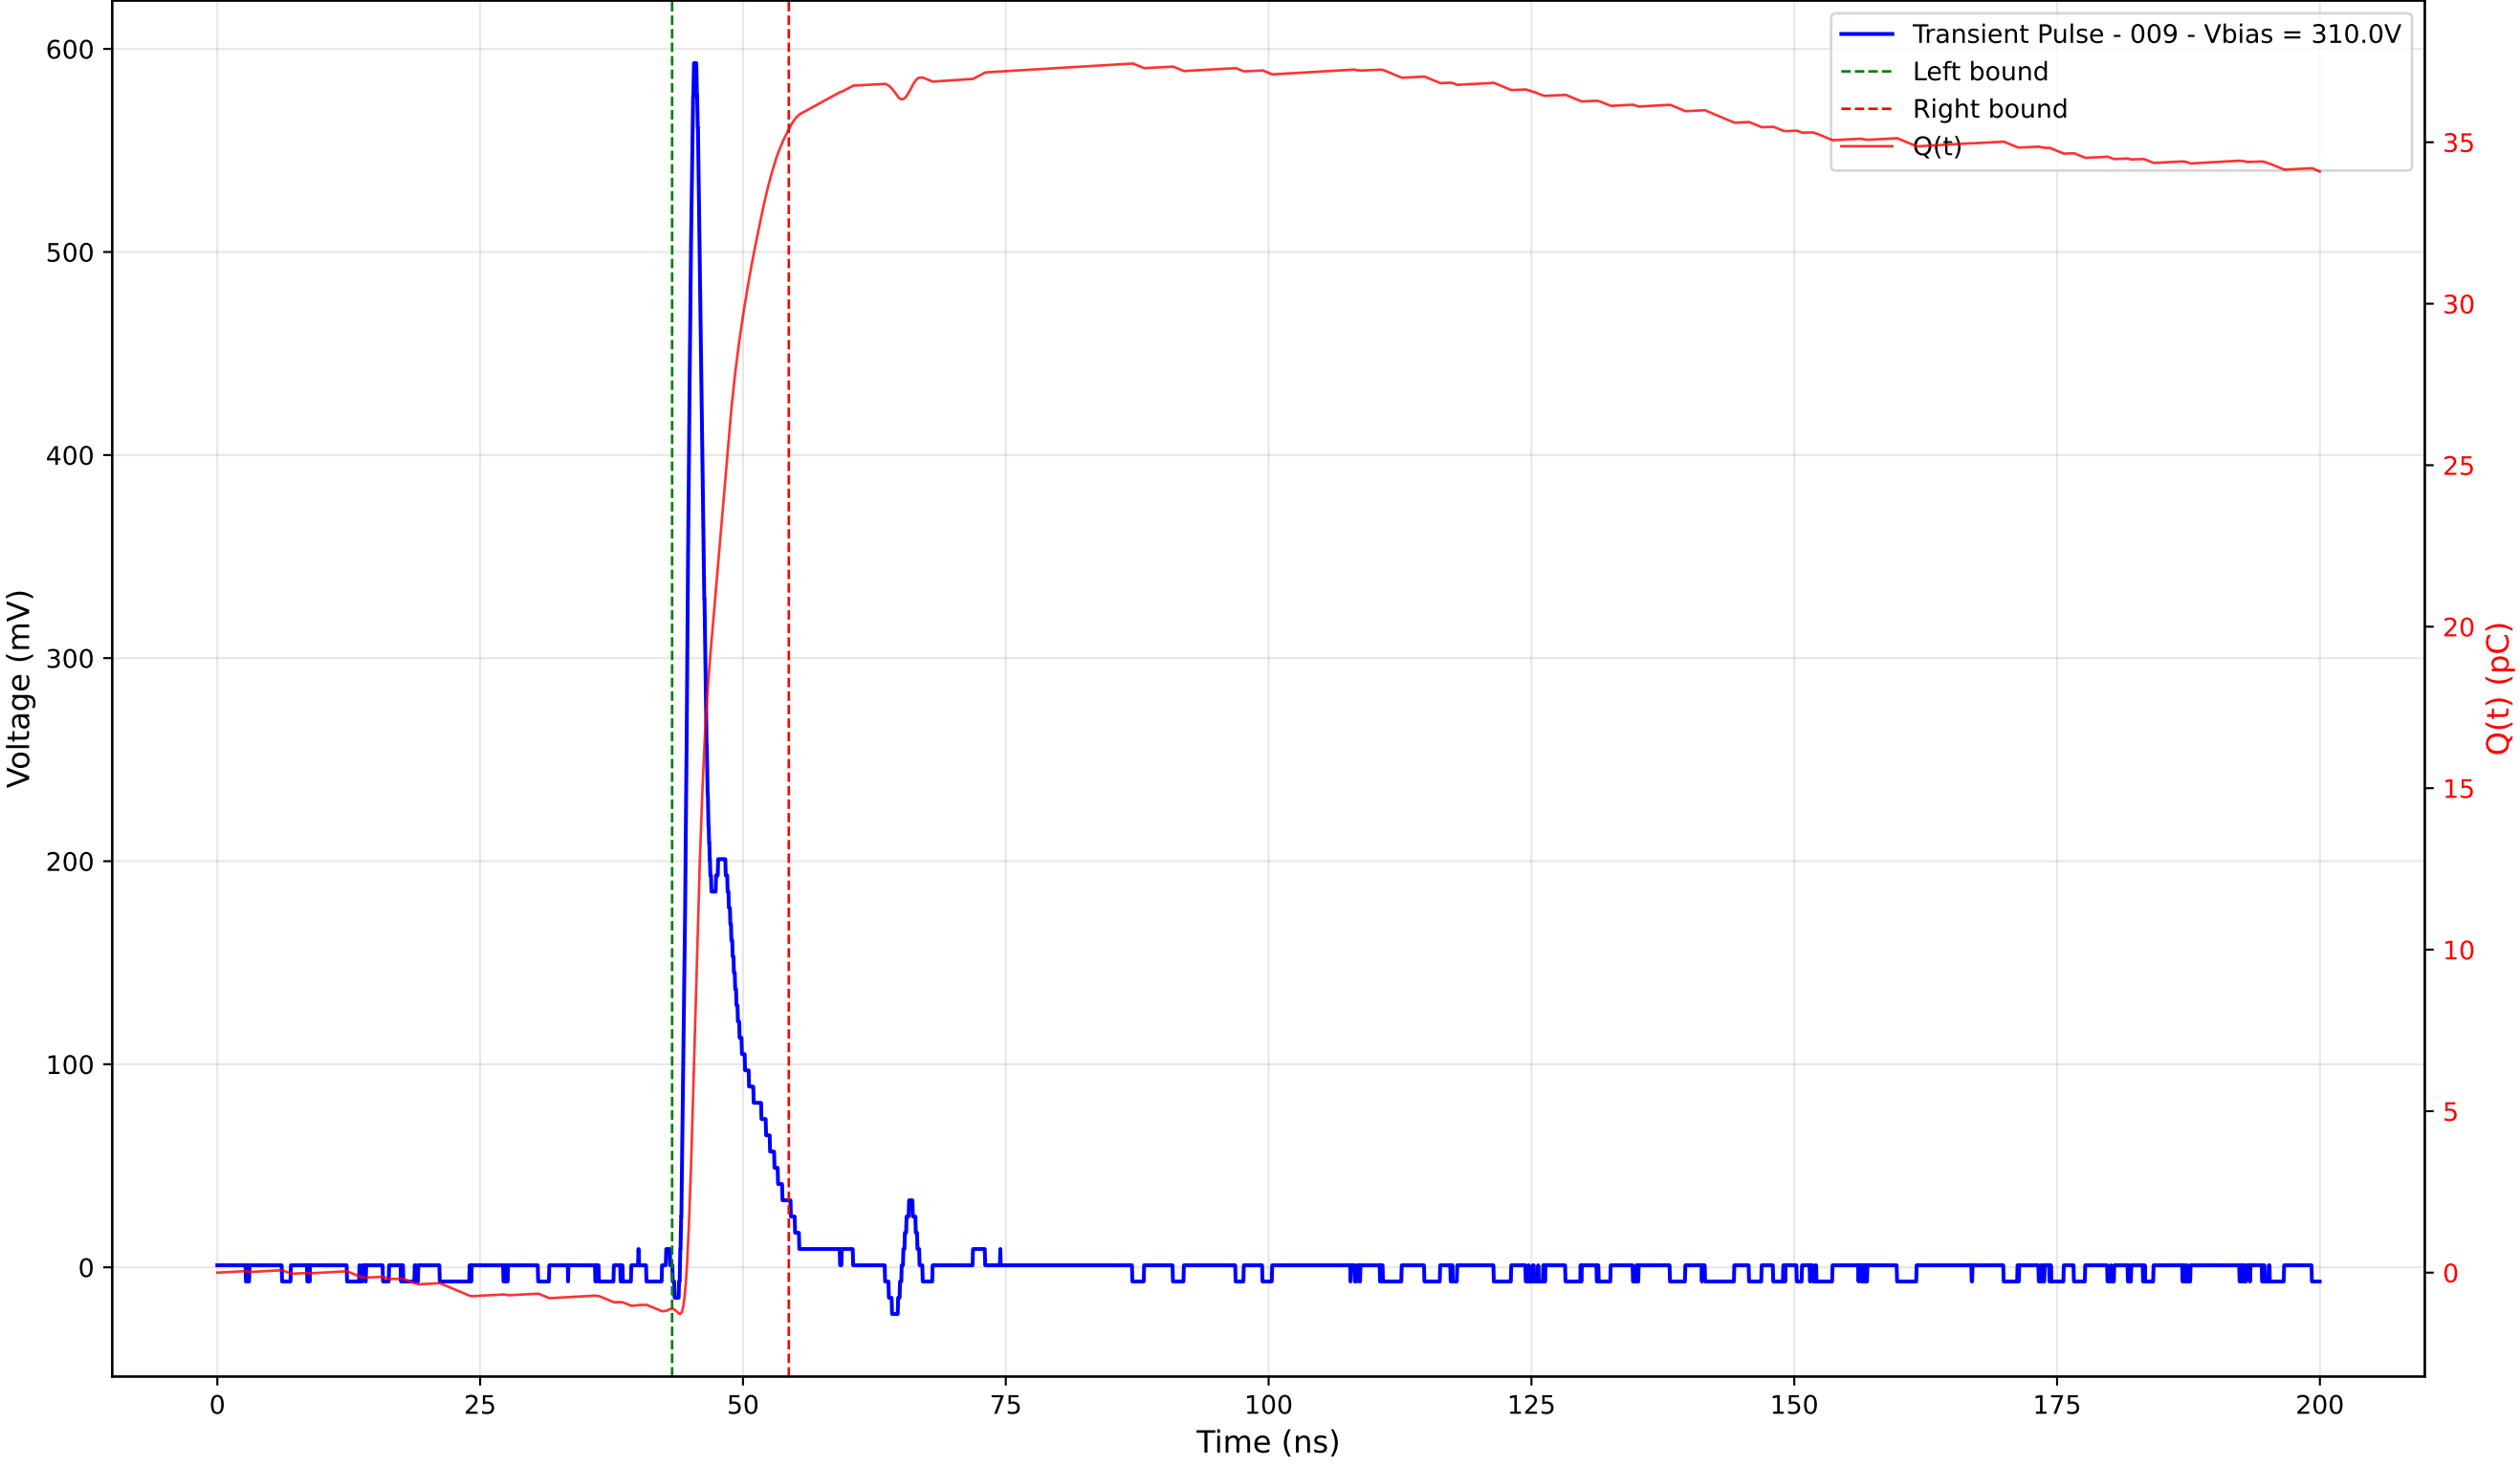


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 36.61 pC - Rise Time: 0.90 ns

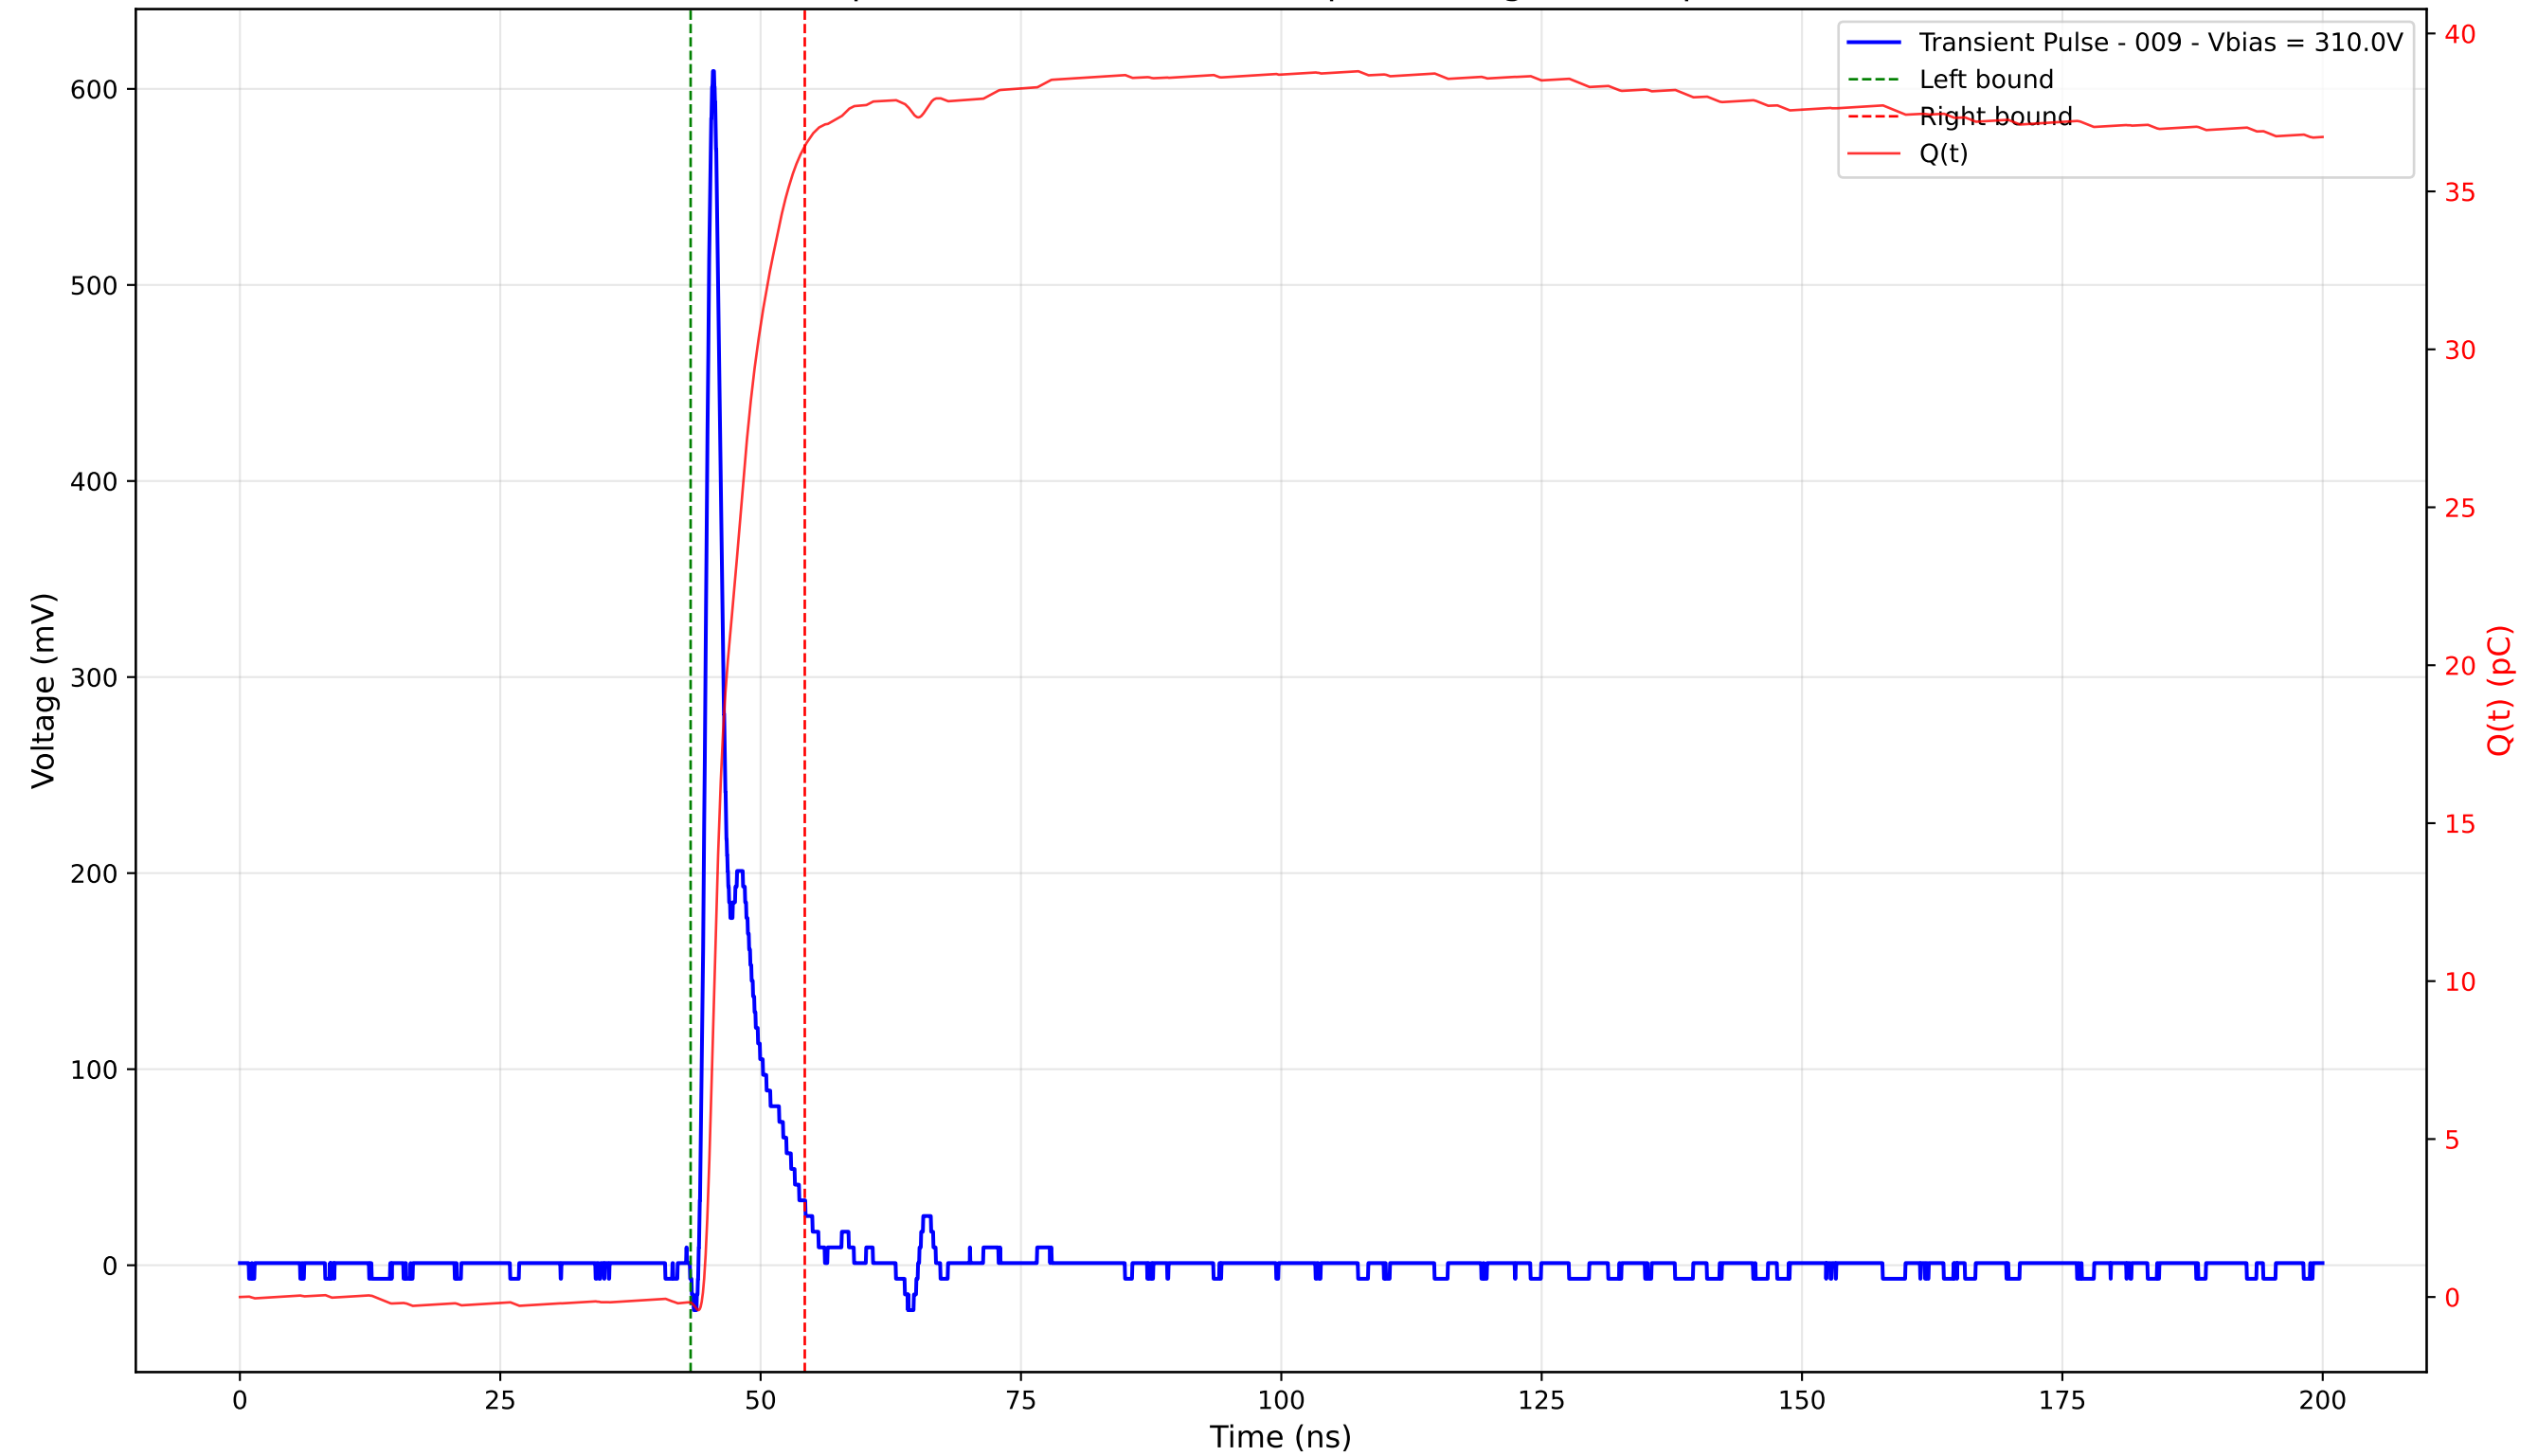


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 36.29 pC - Rise Time: 0.90 ns

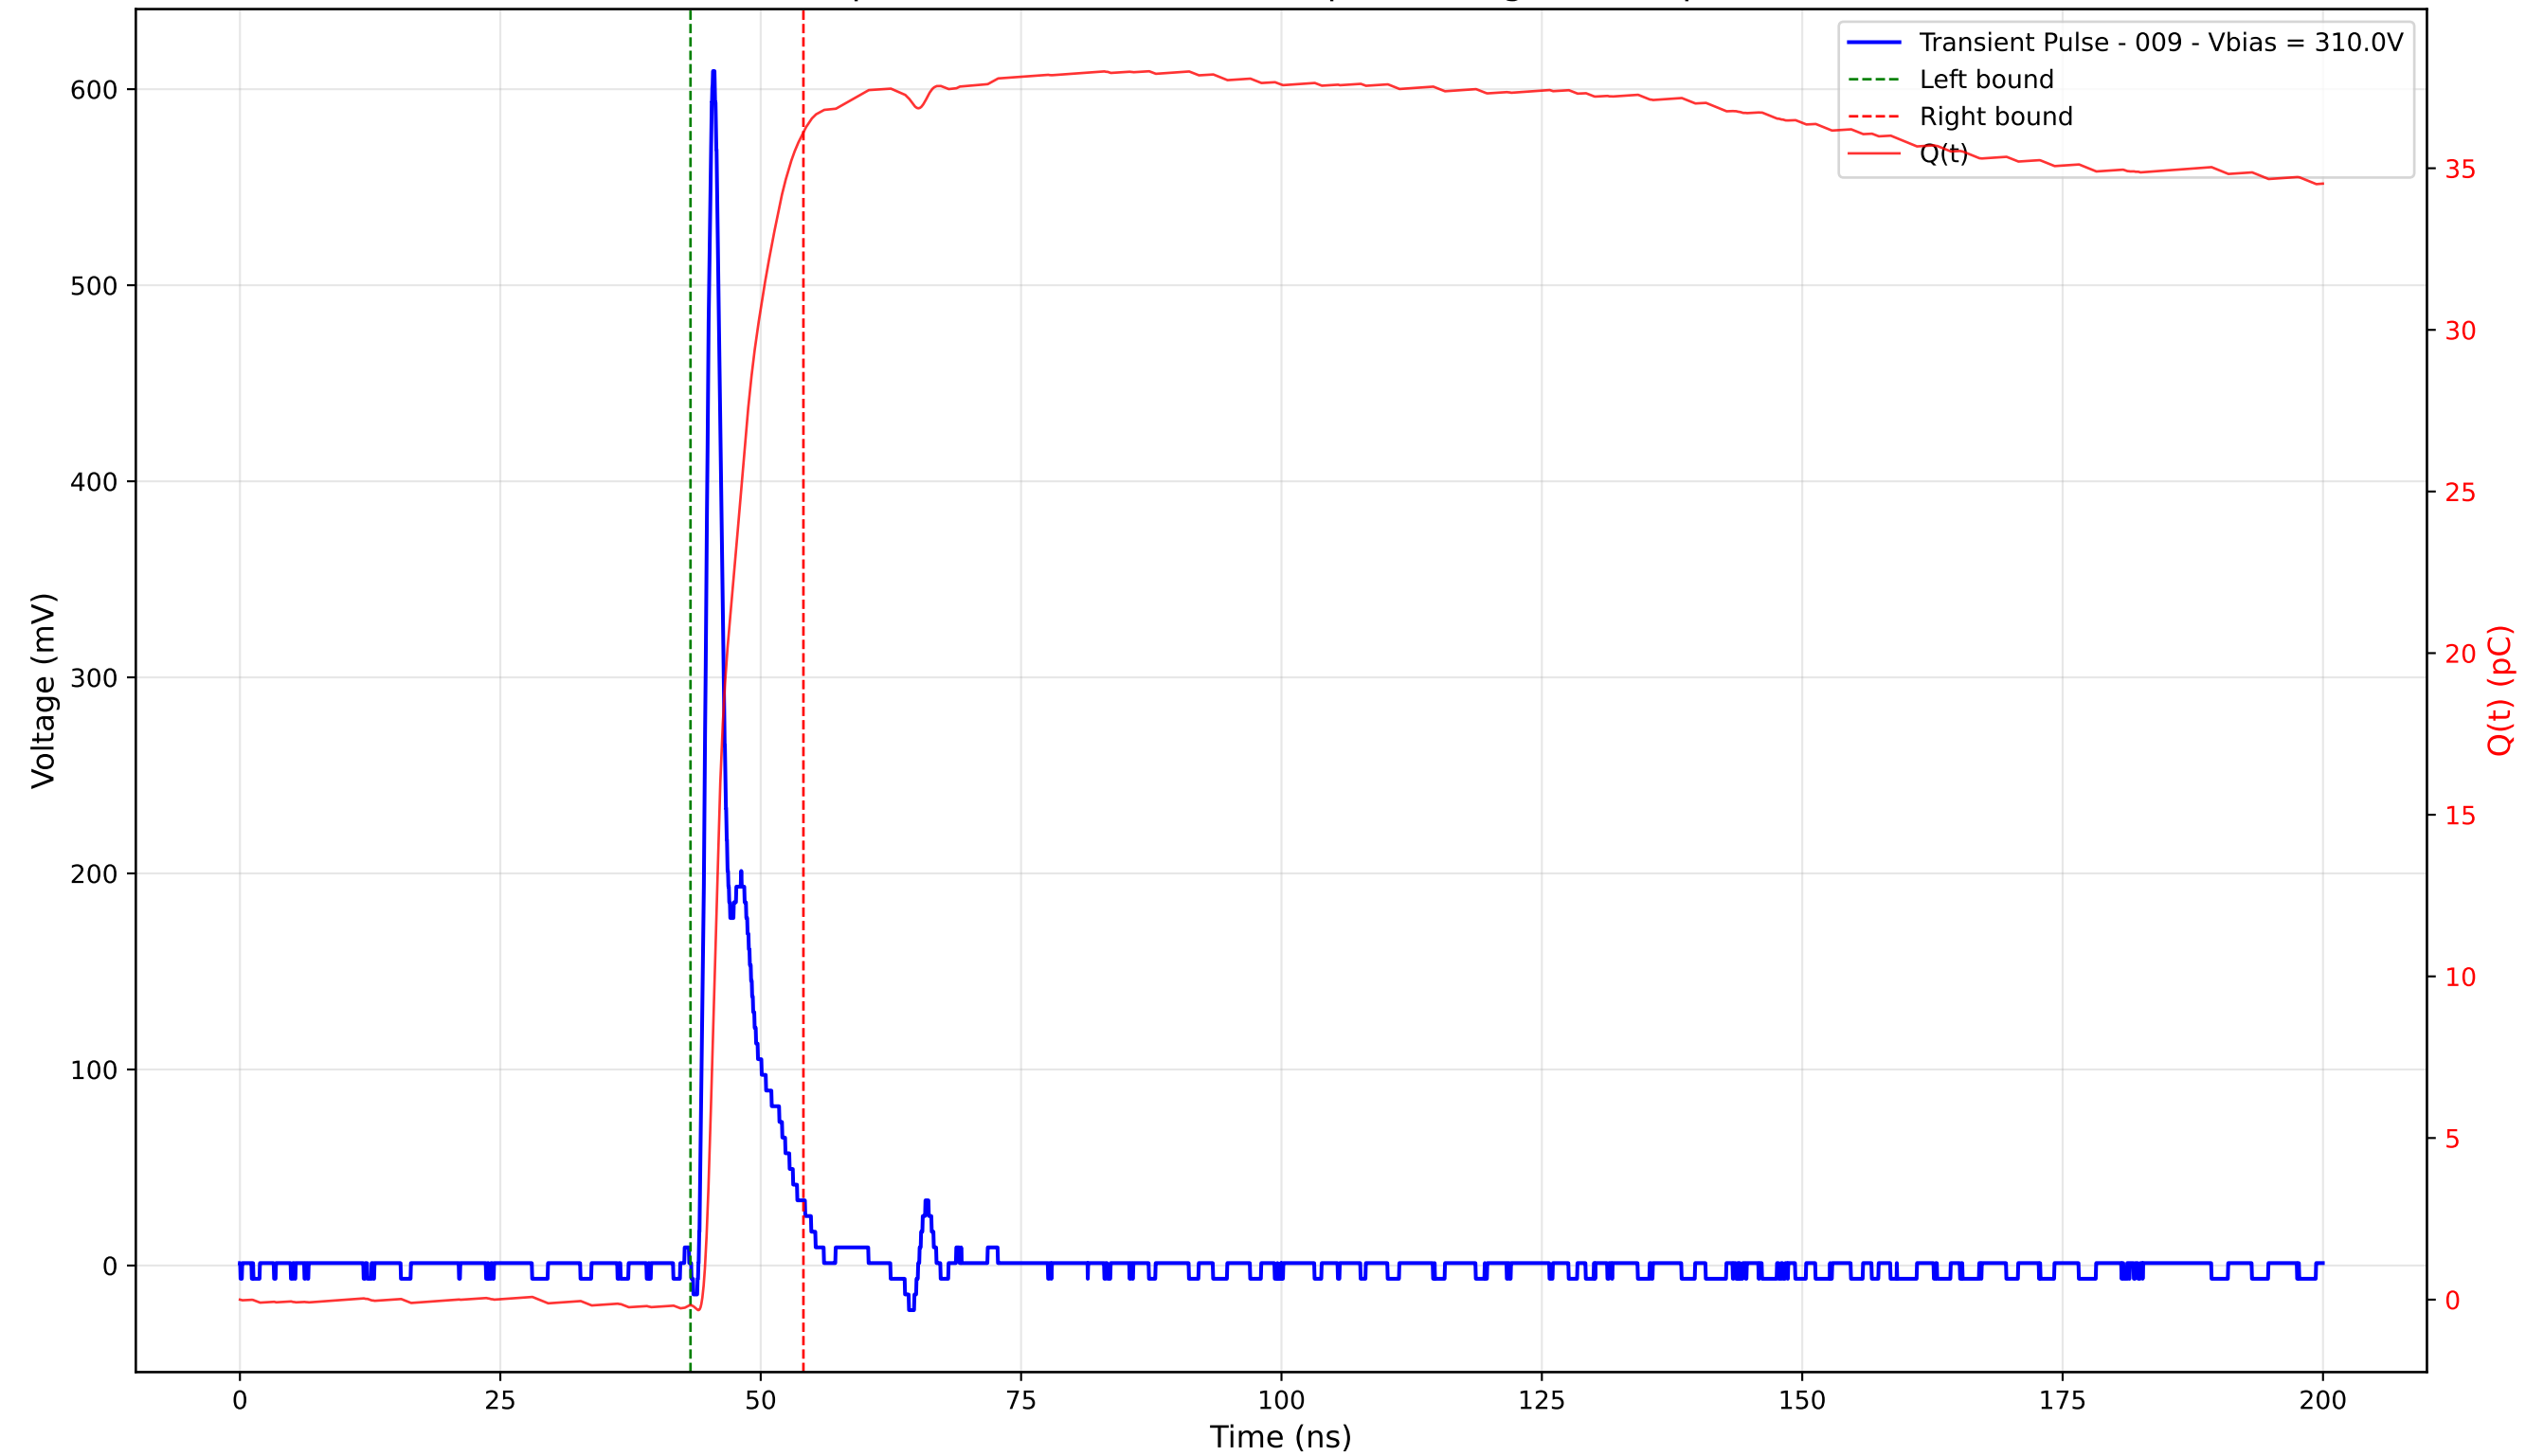


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 36.38 pC - Rise Time: 0.90 ns

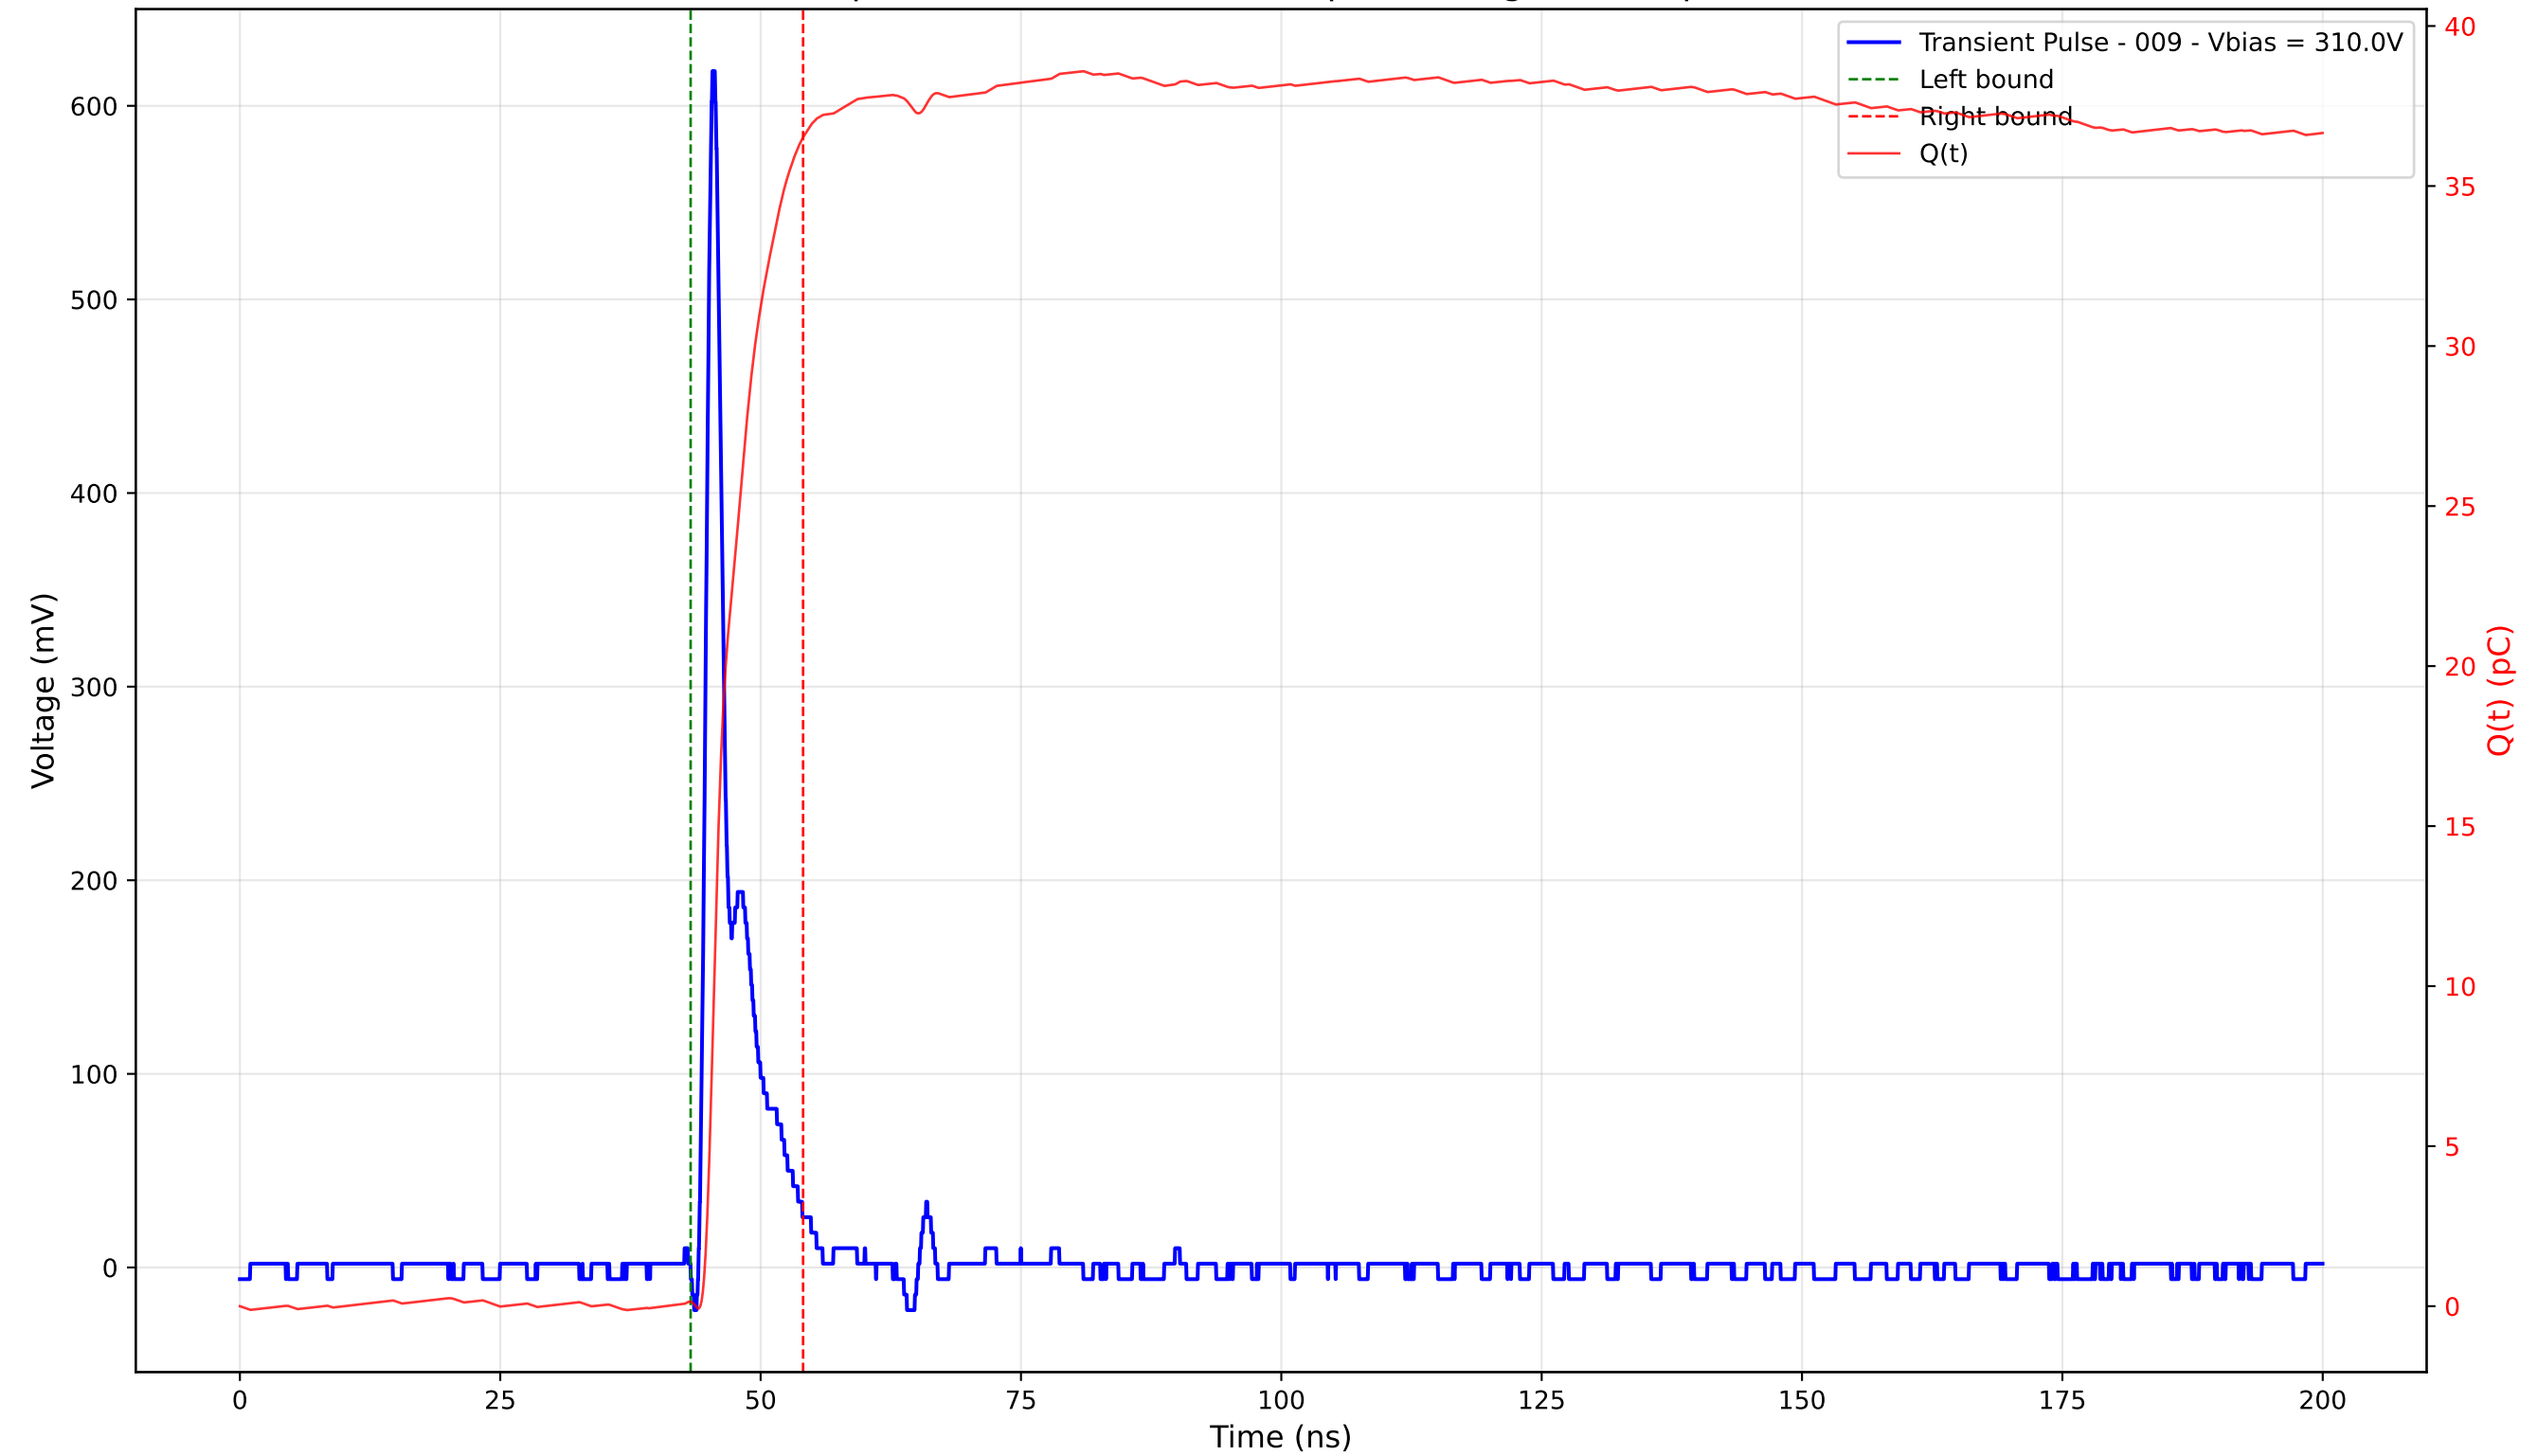


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 36.39 pC - Rise Time: 0.91 ns

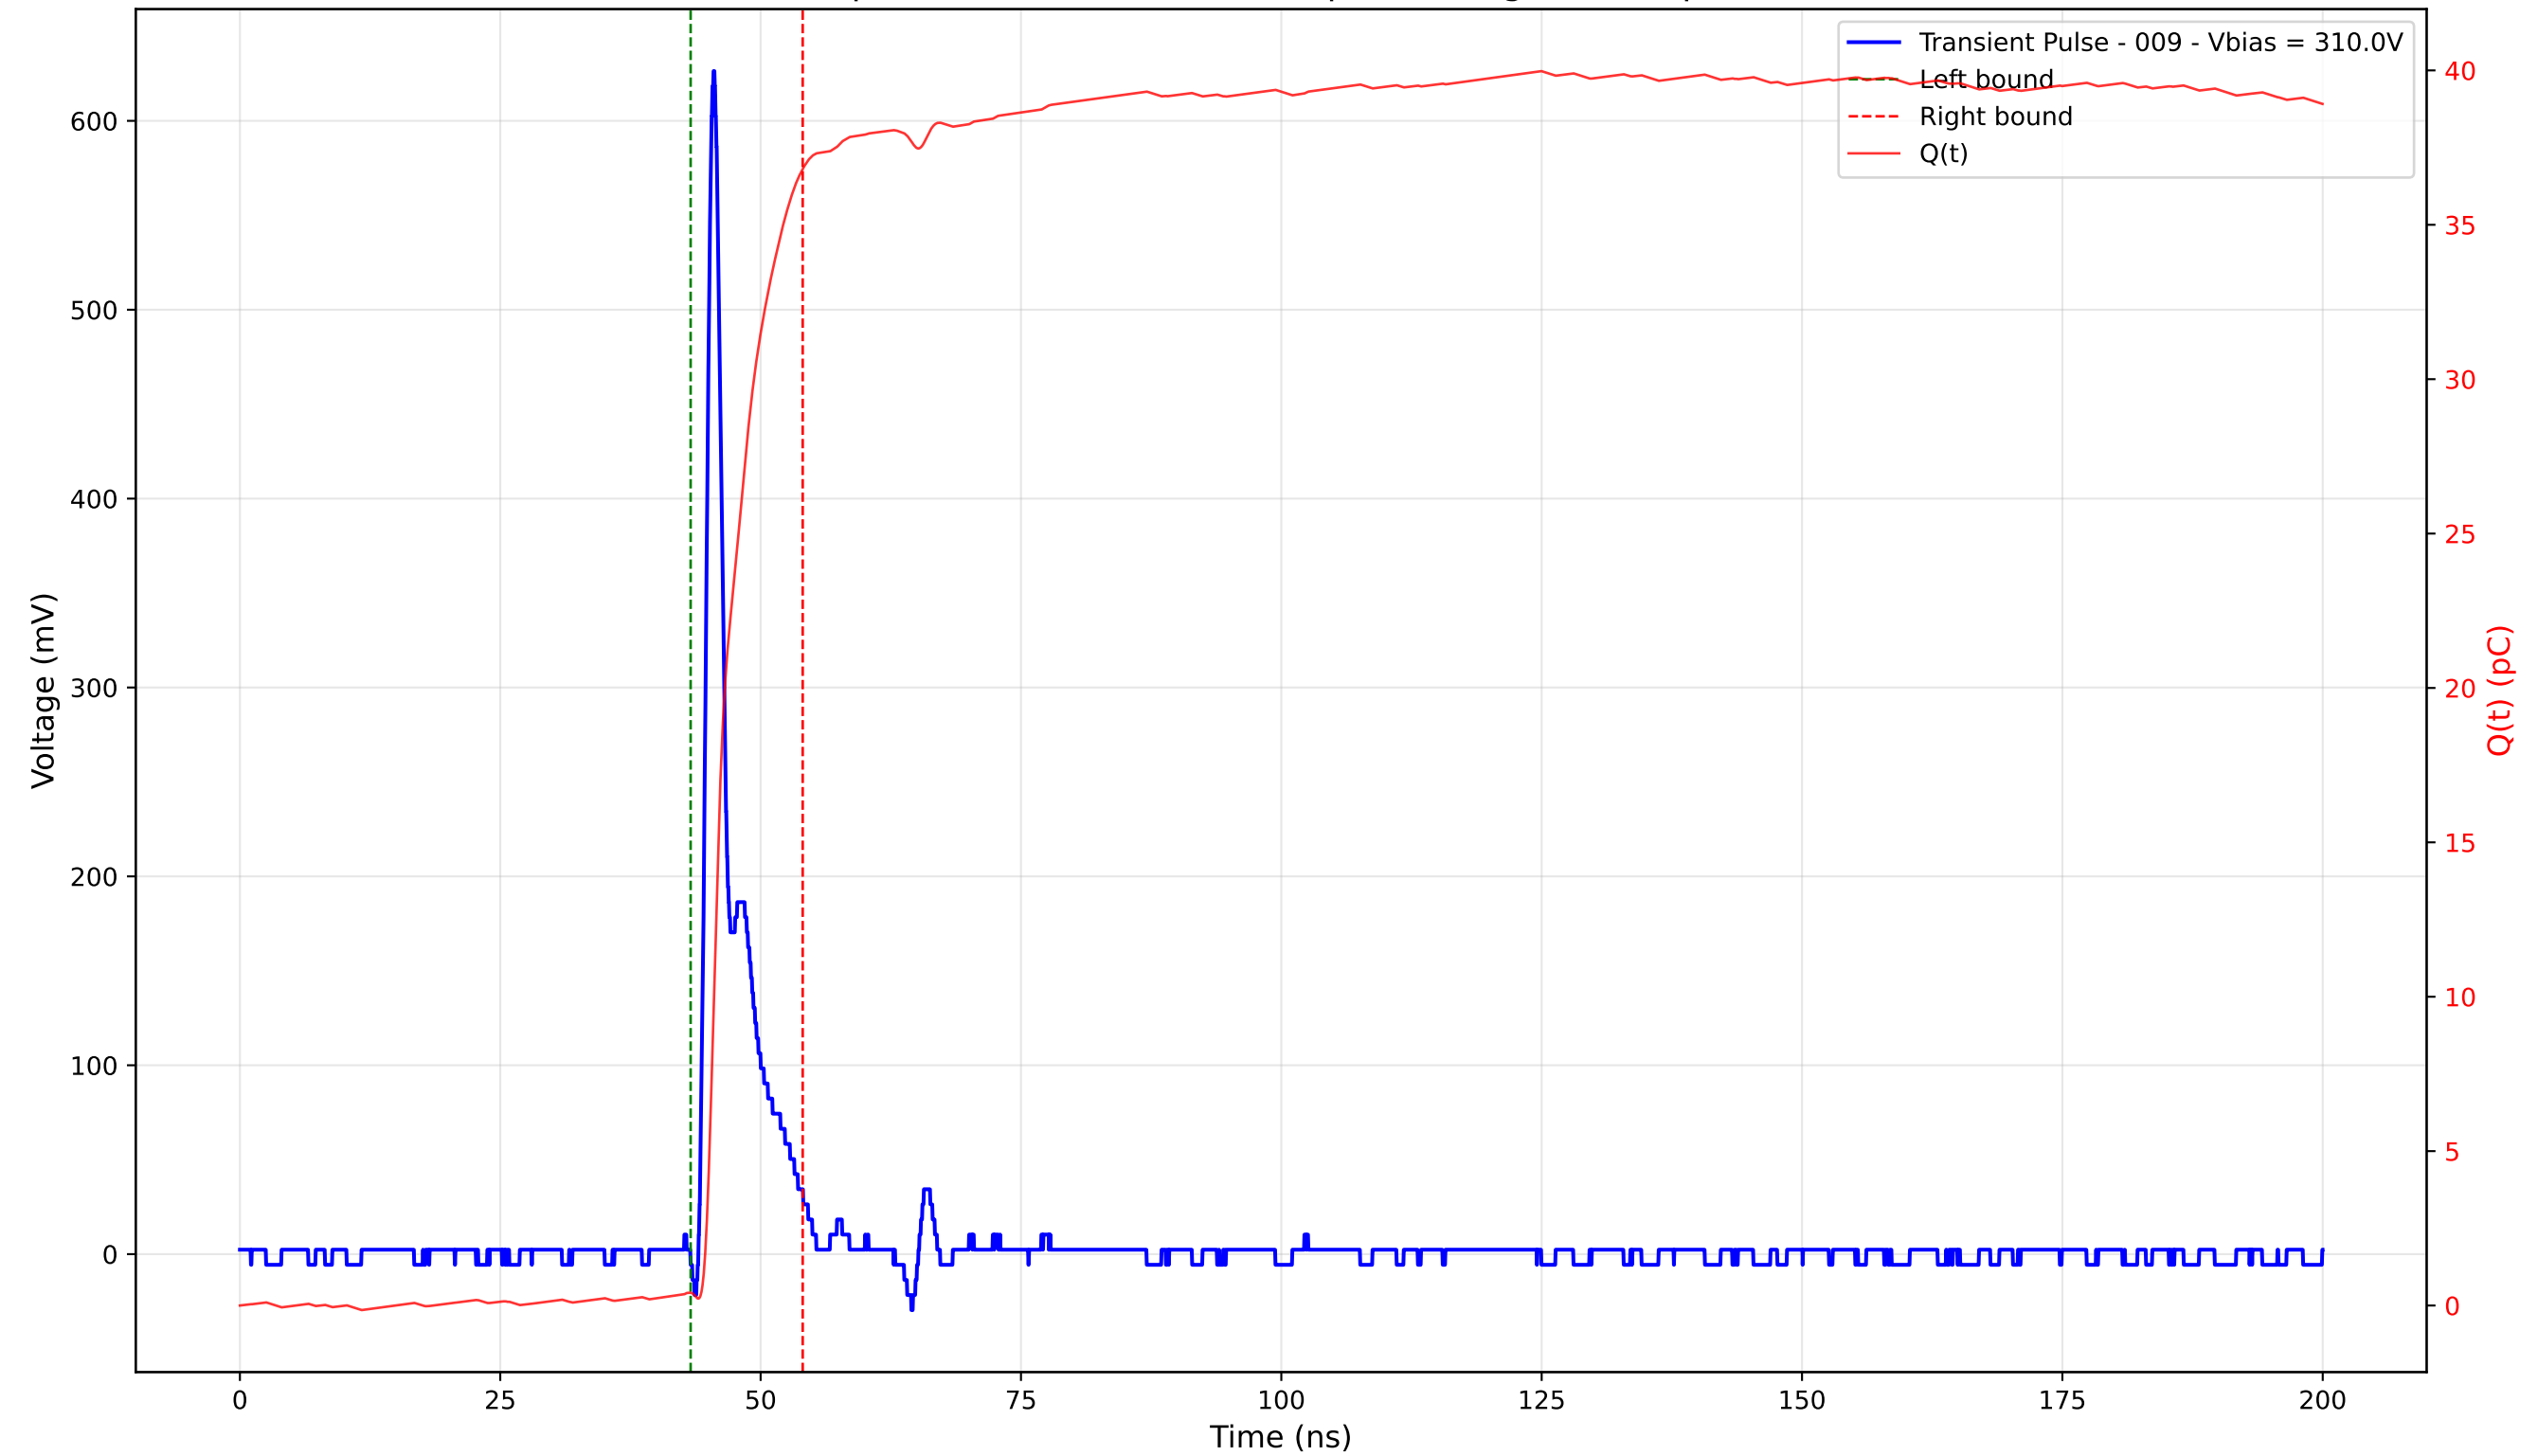


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 36.20 pC - Rise Time: 0.95 ns

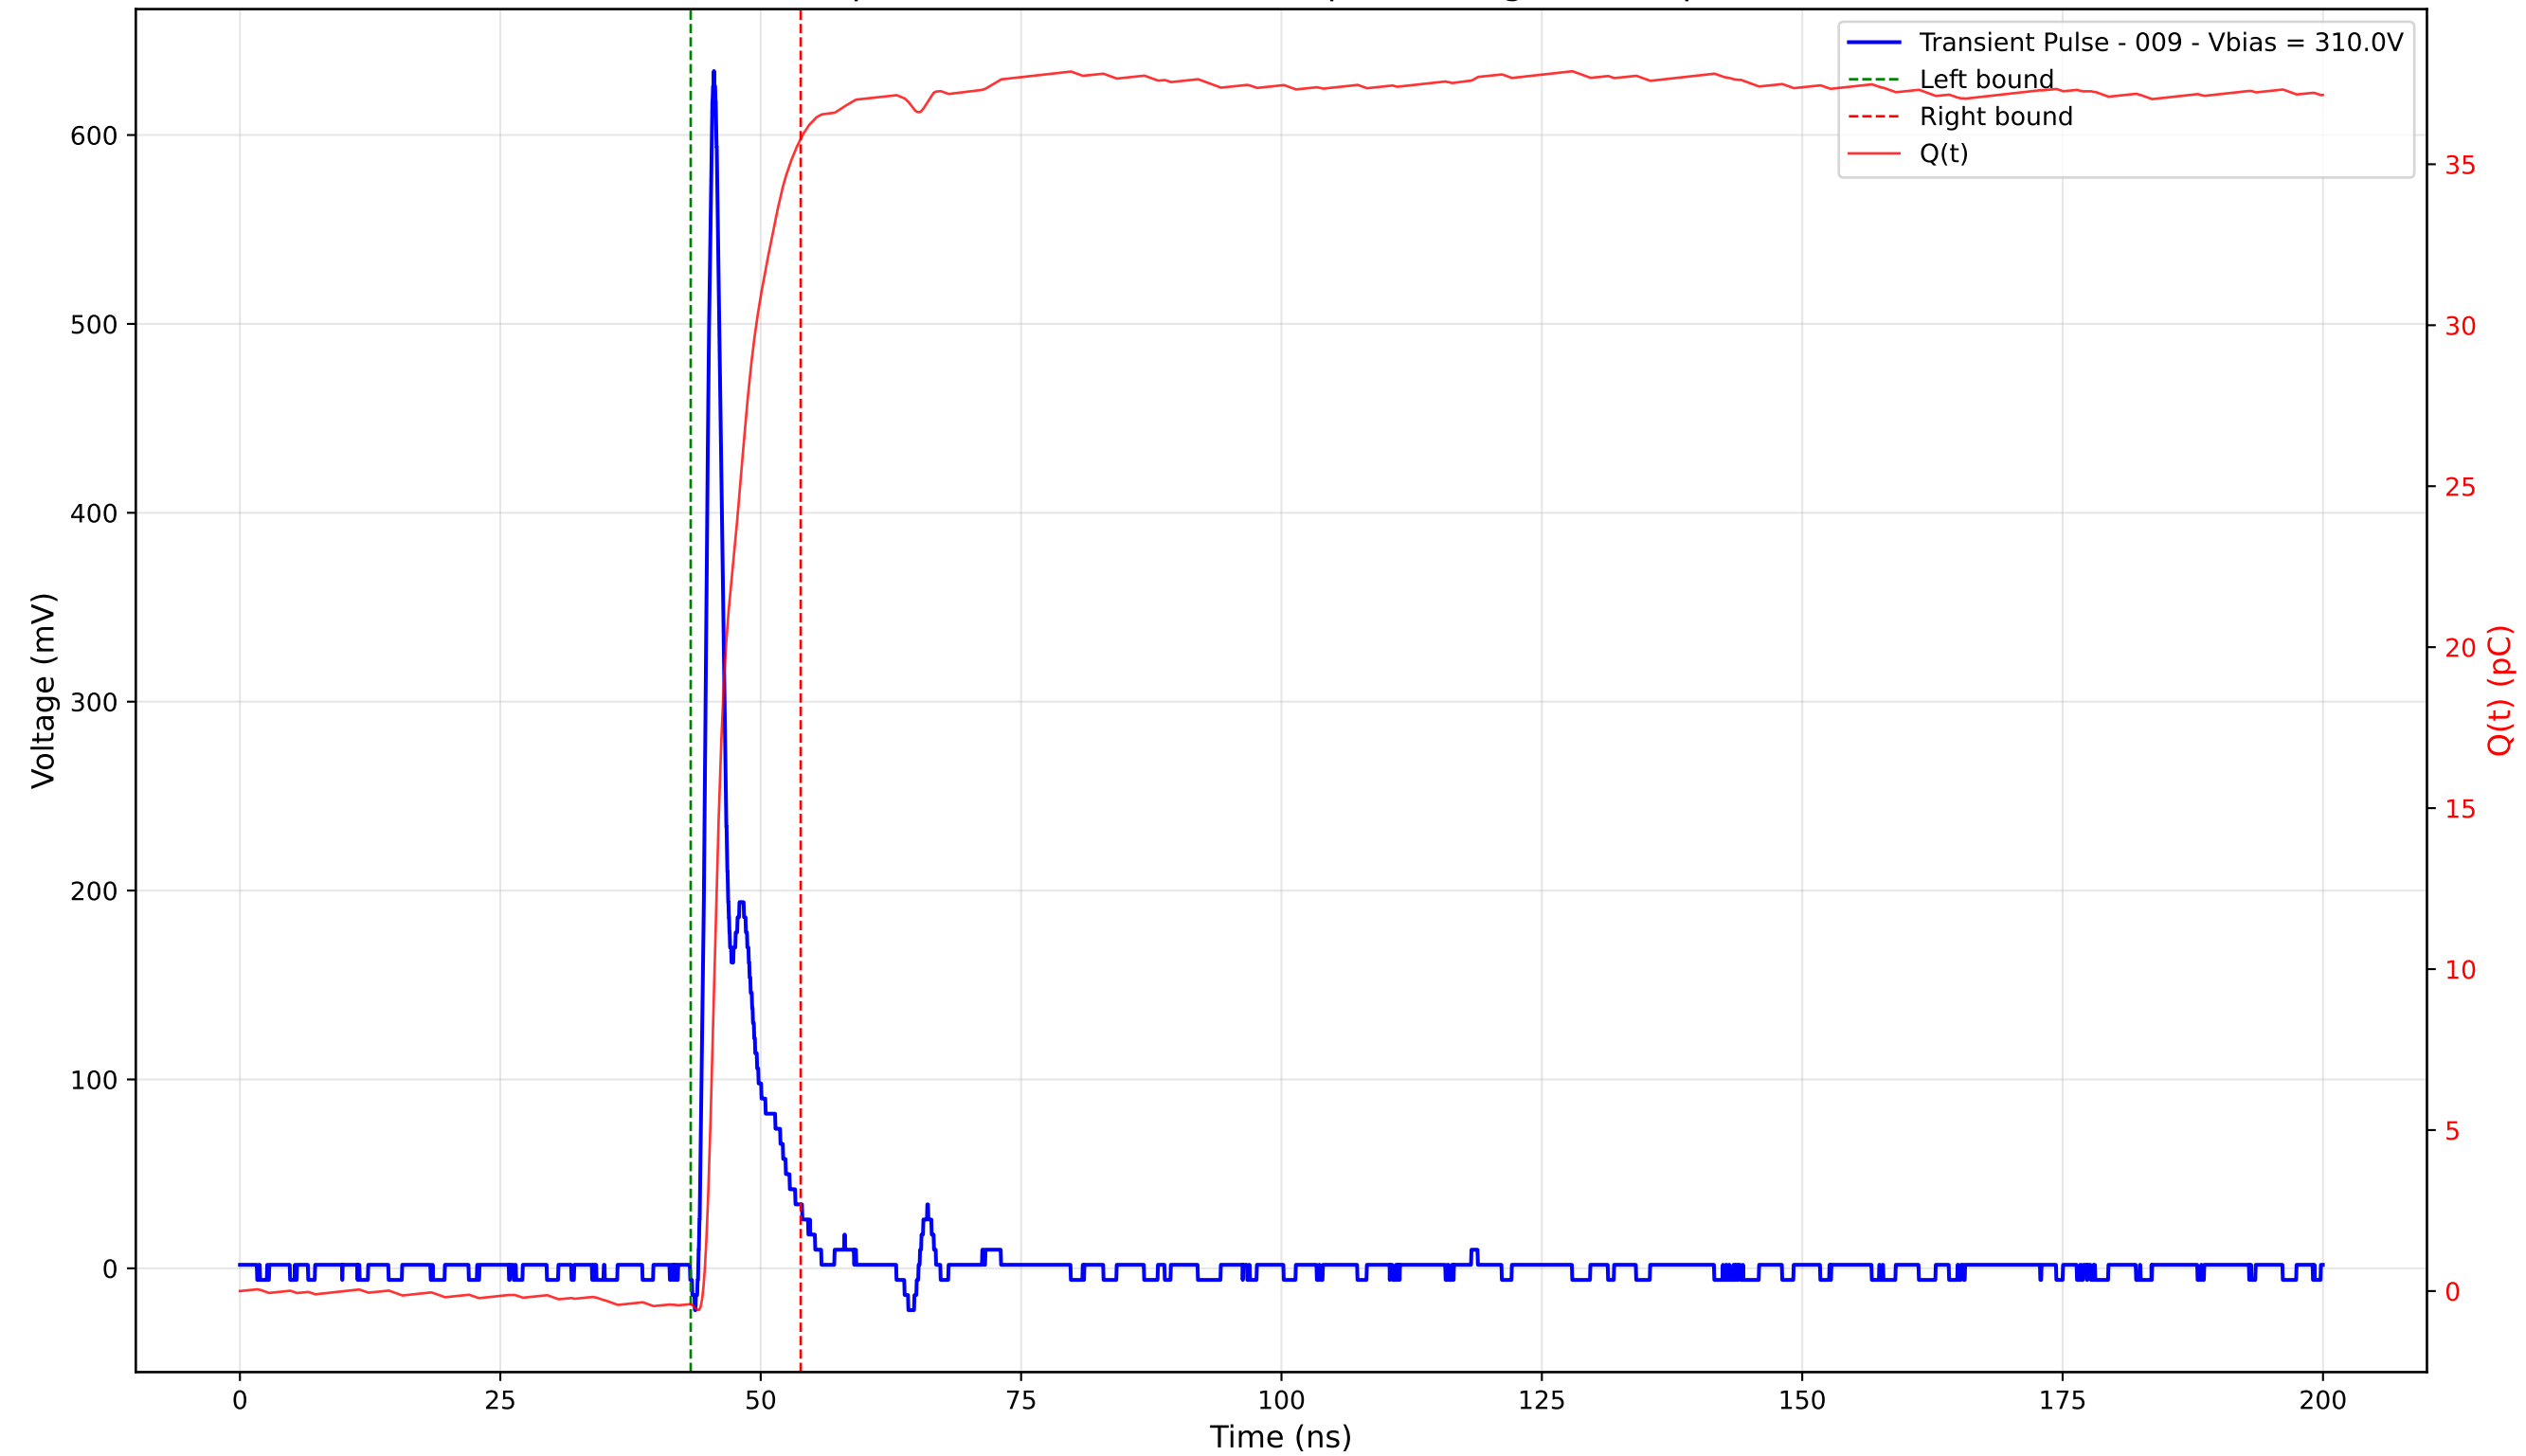


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 35.77 pC - Rise Time: 0.94 ns

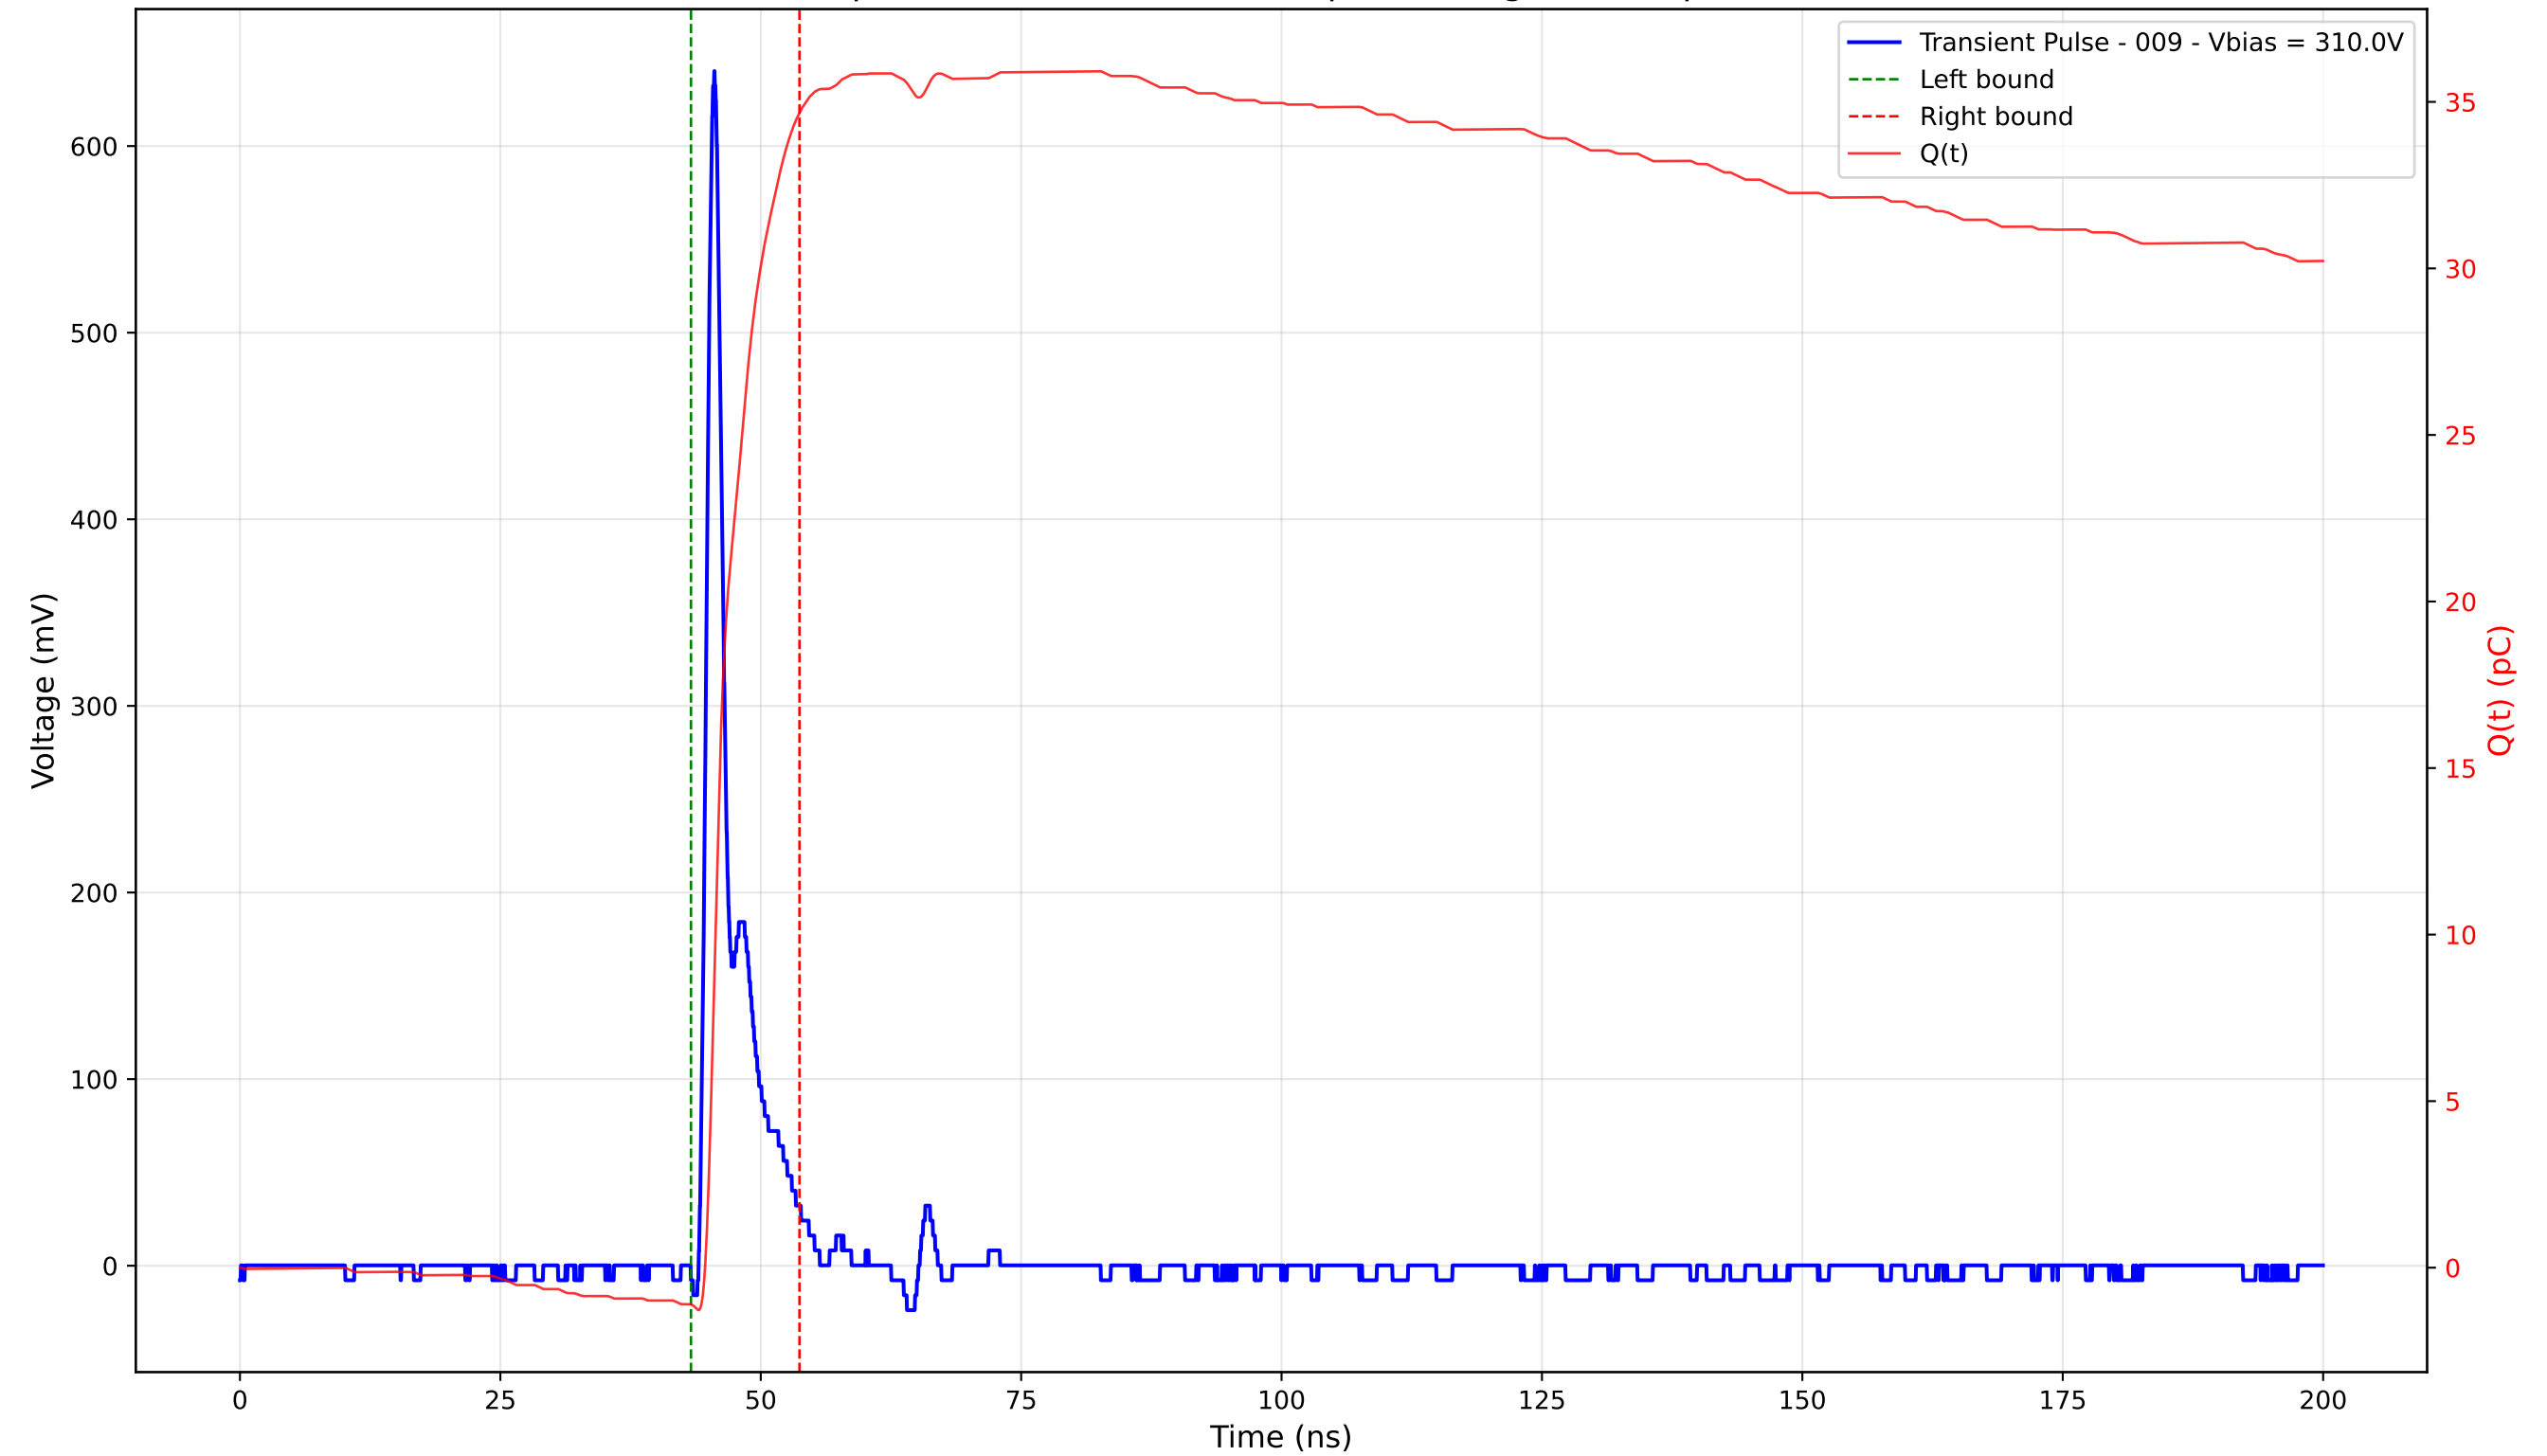


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 36.45 pC - Rise Time: 0.92 ns

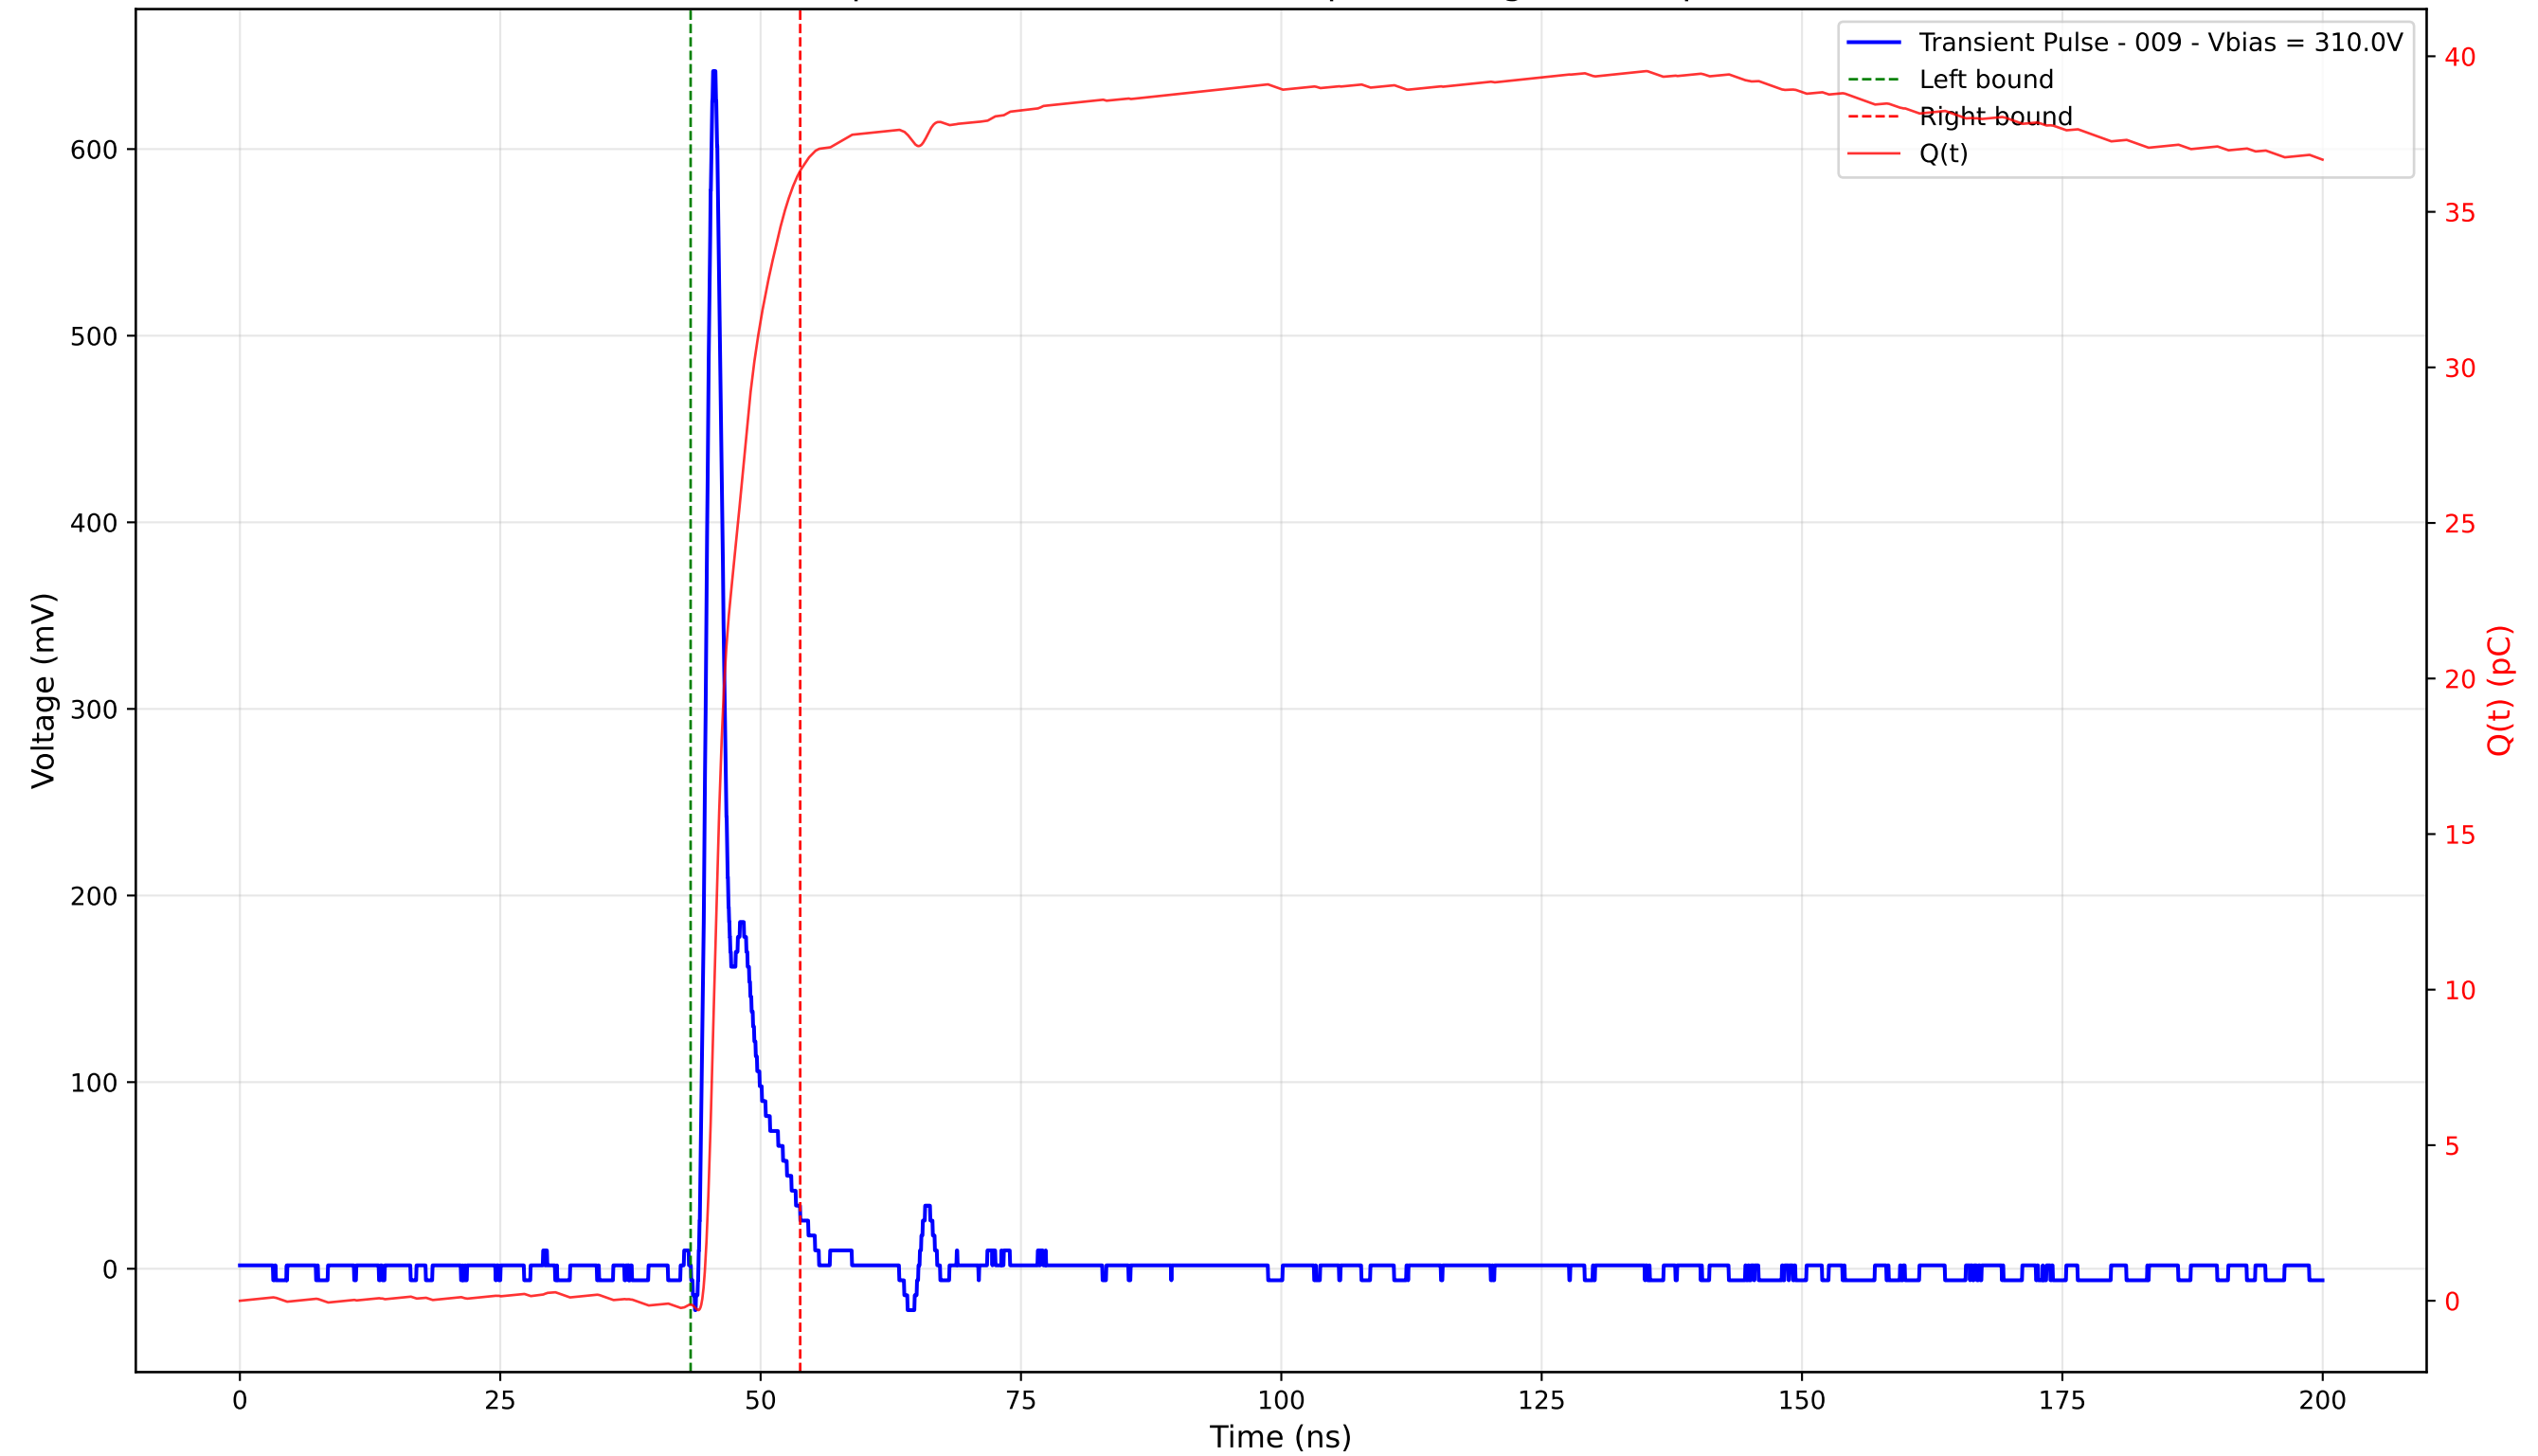


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 35.89 pC - Rise Time: 0.98 ns

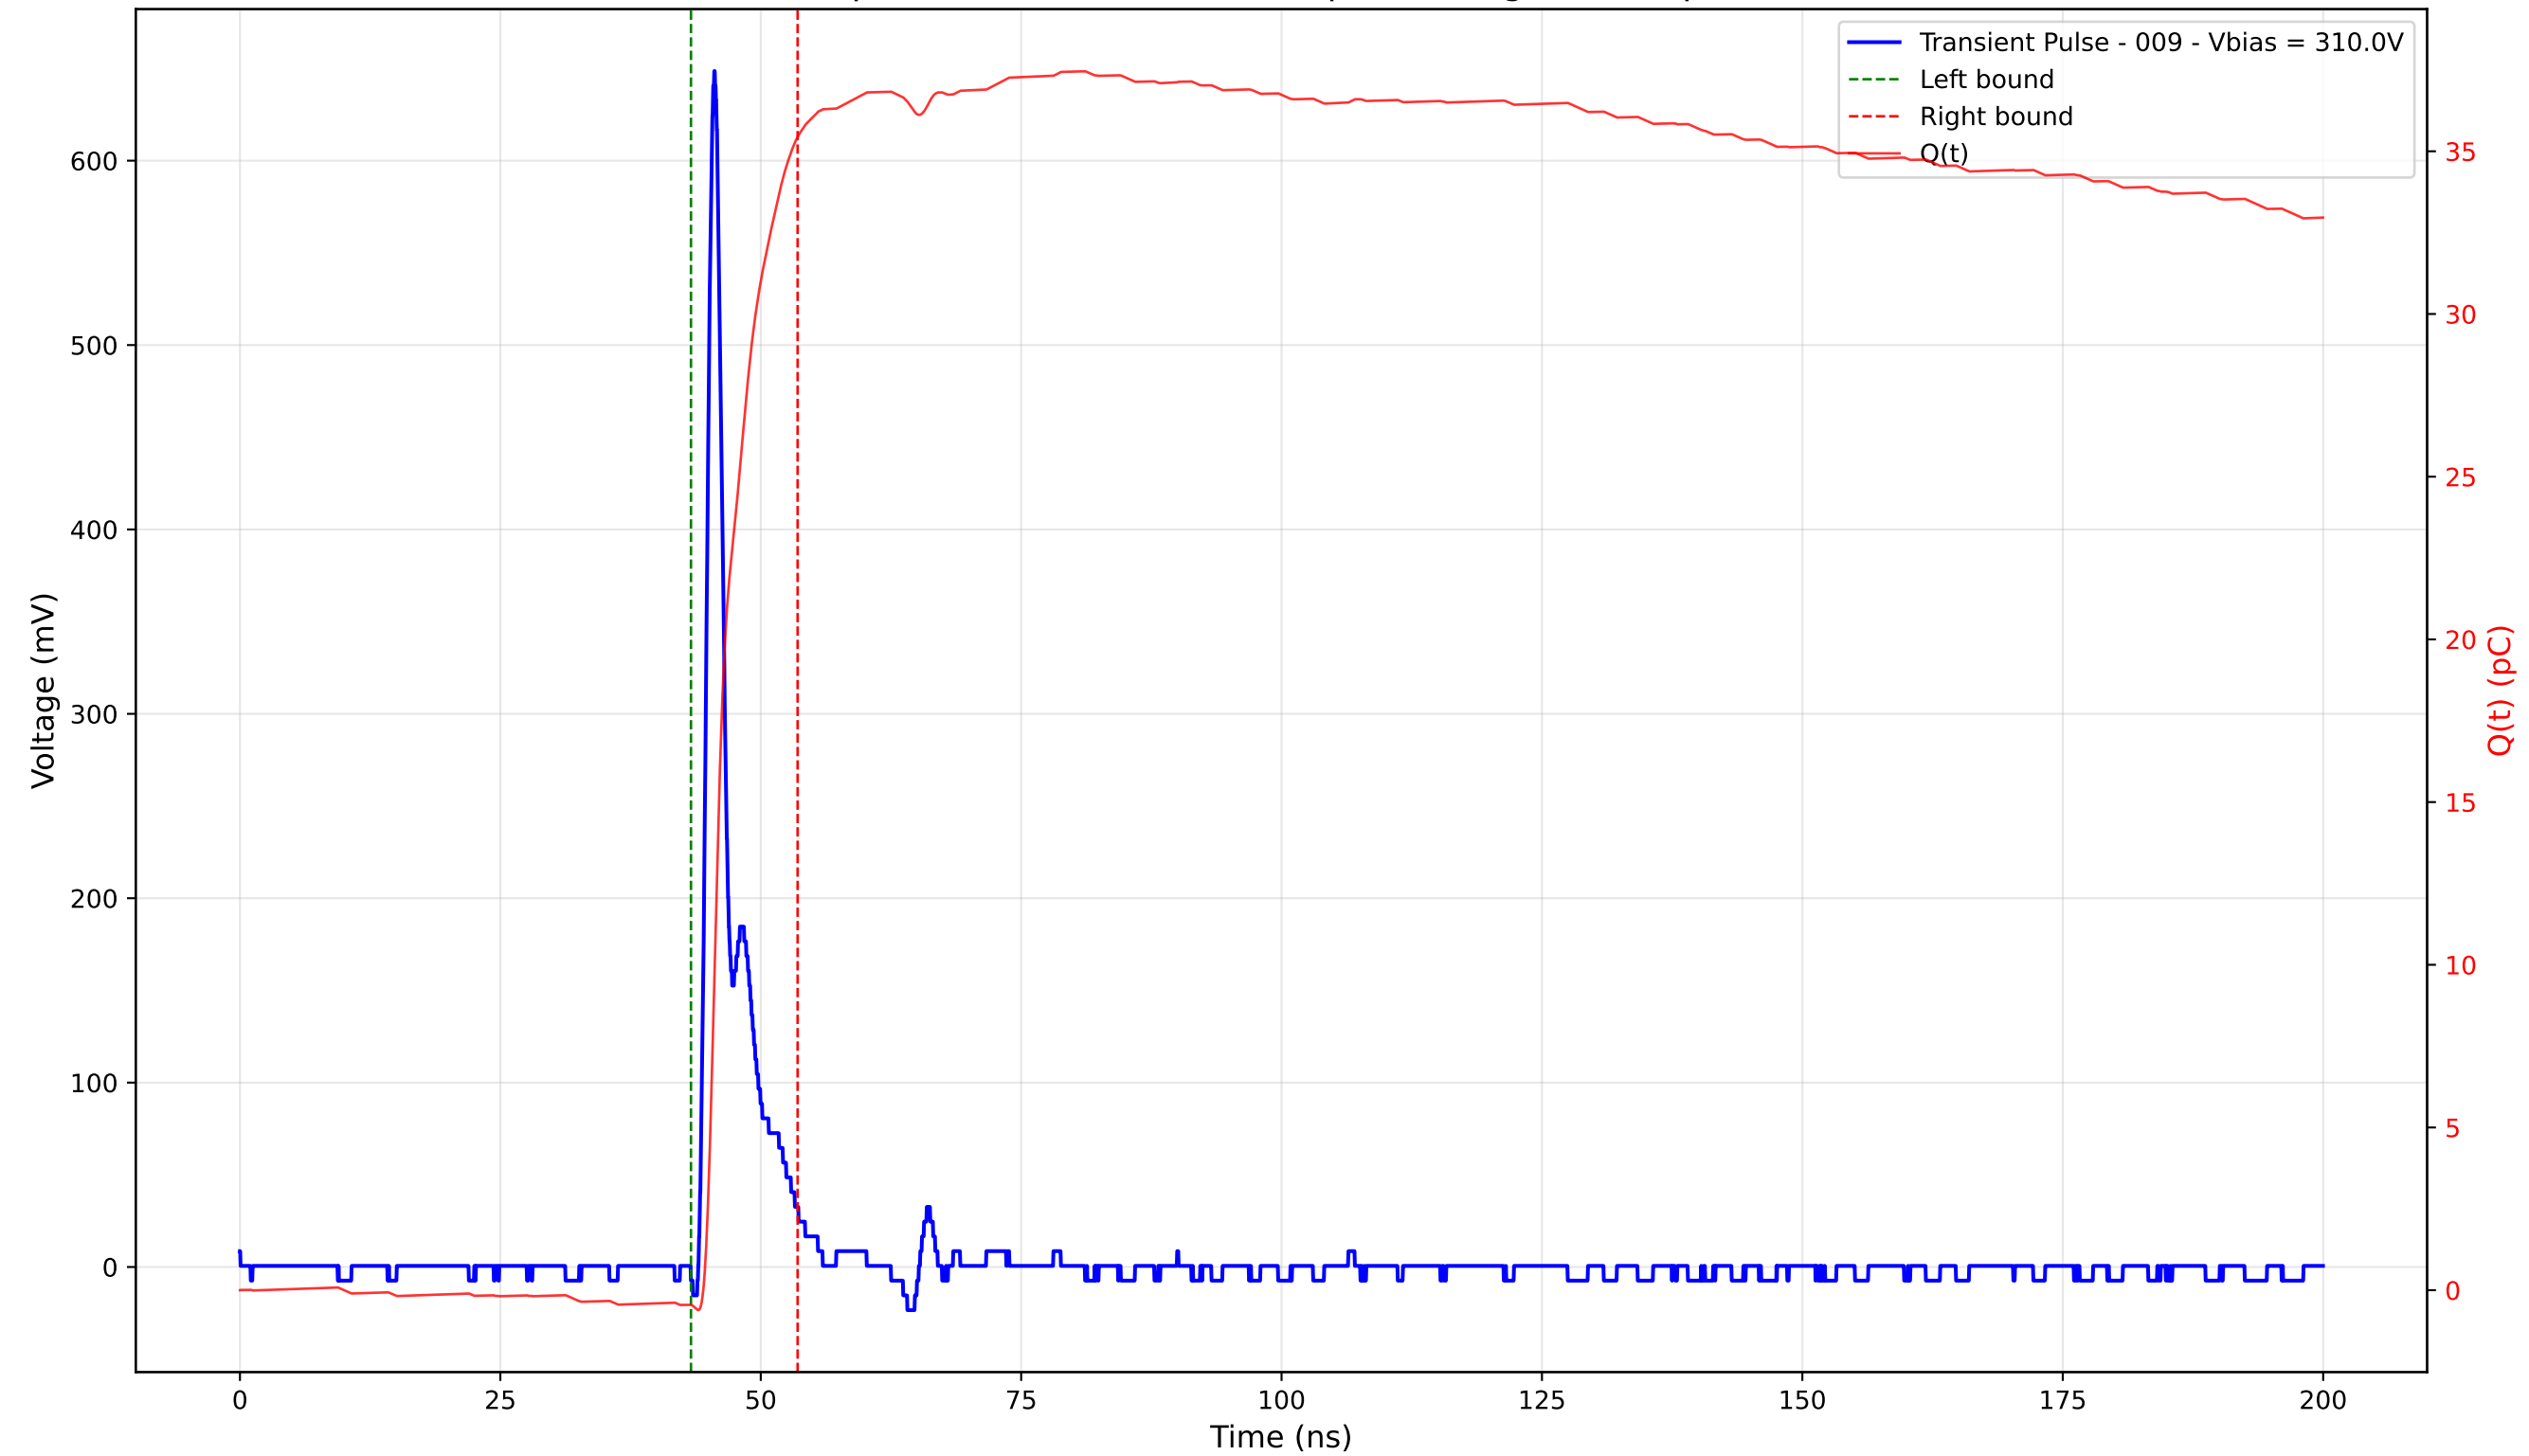


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 36.27 pC - Rise Time: 0.97 ns

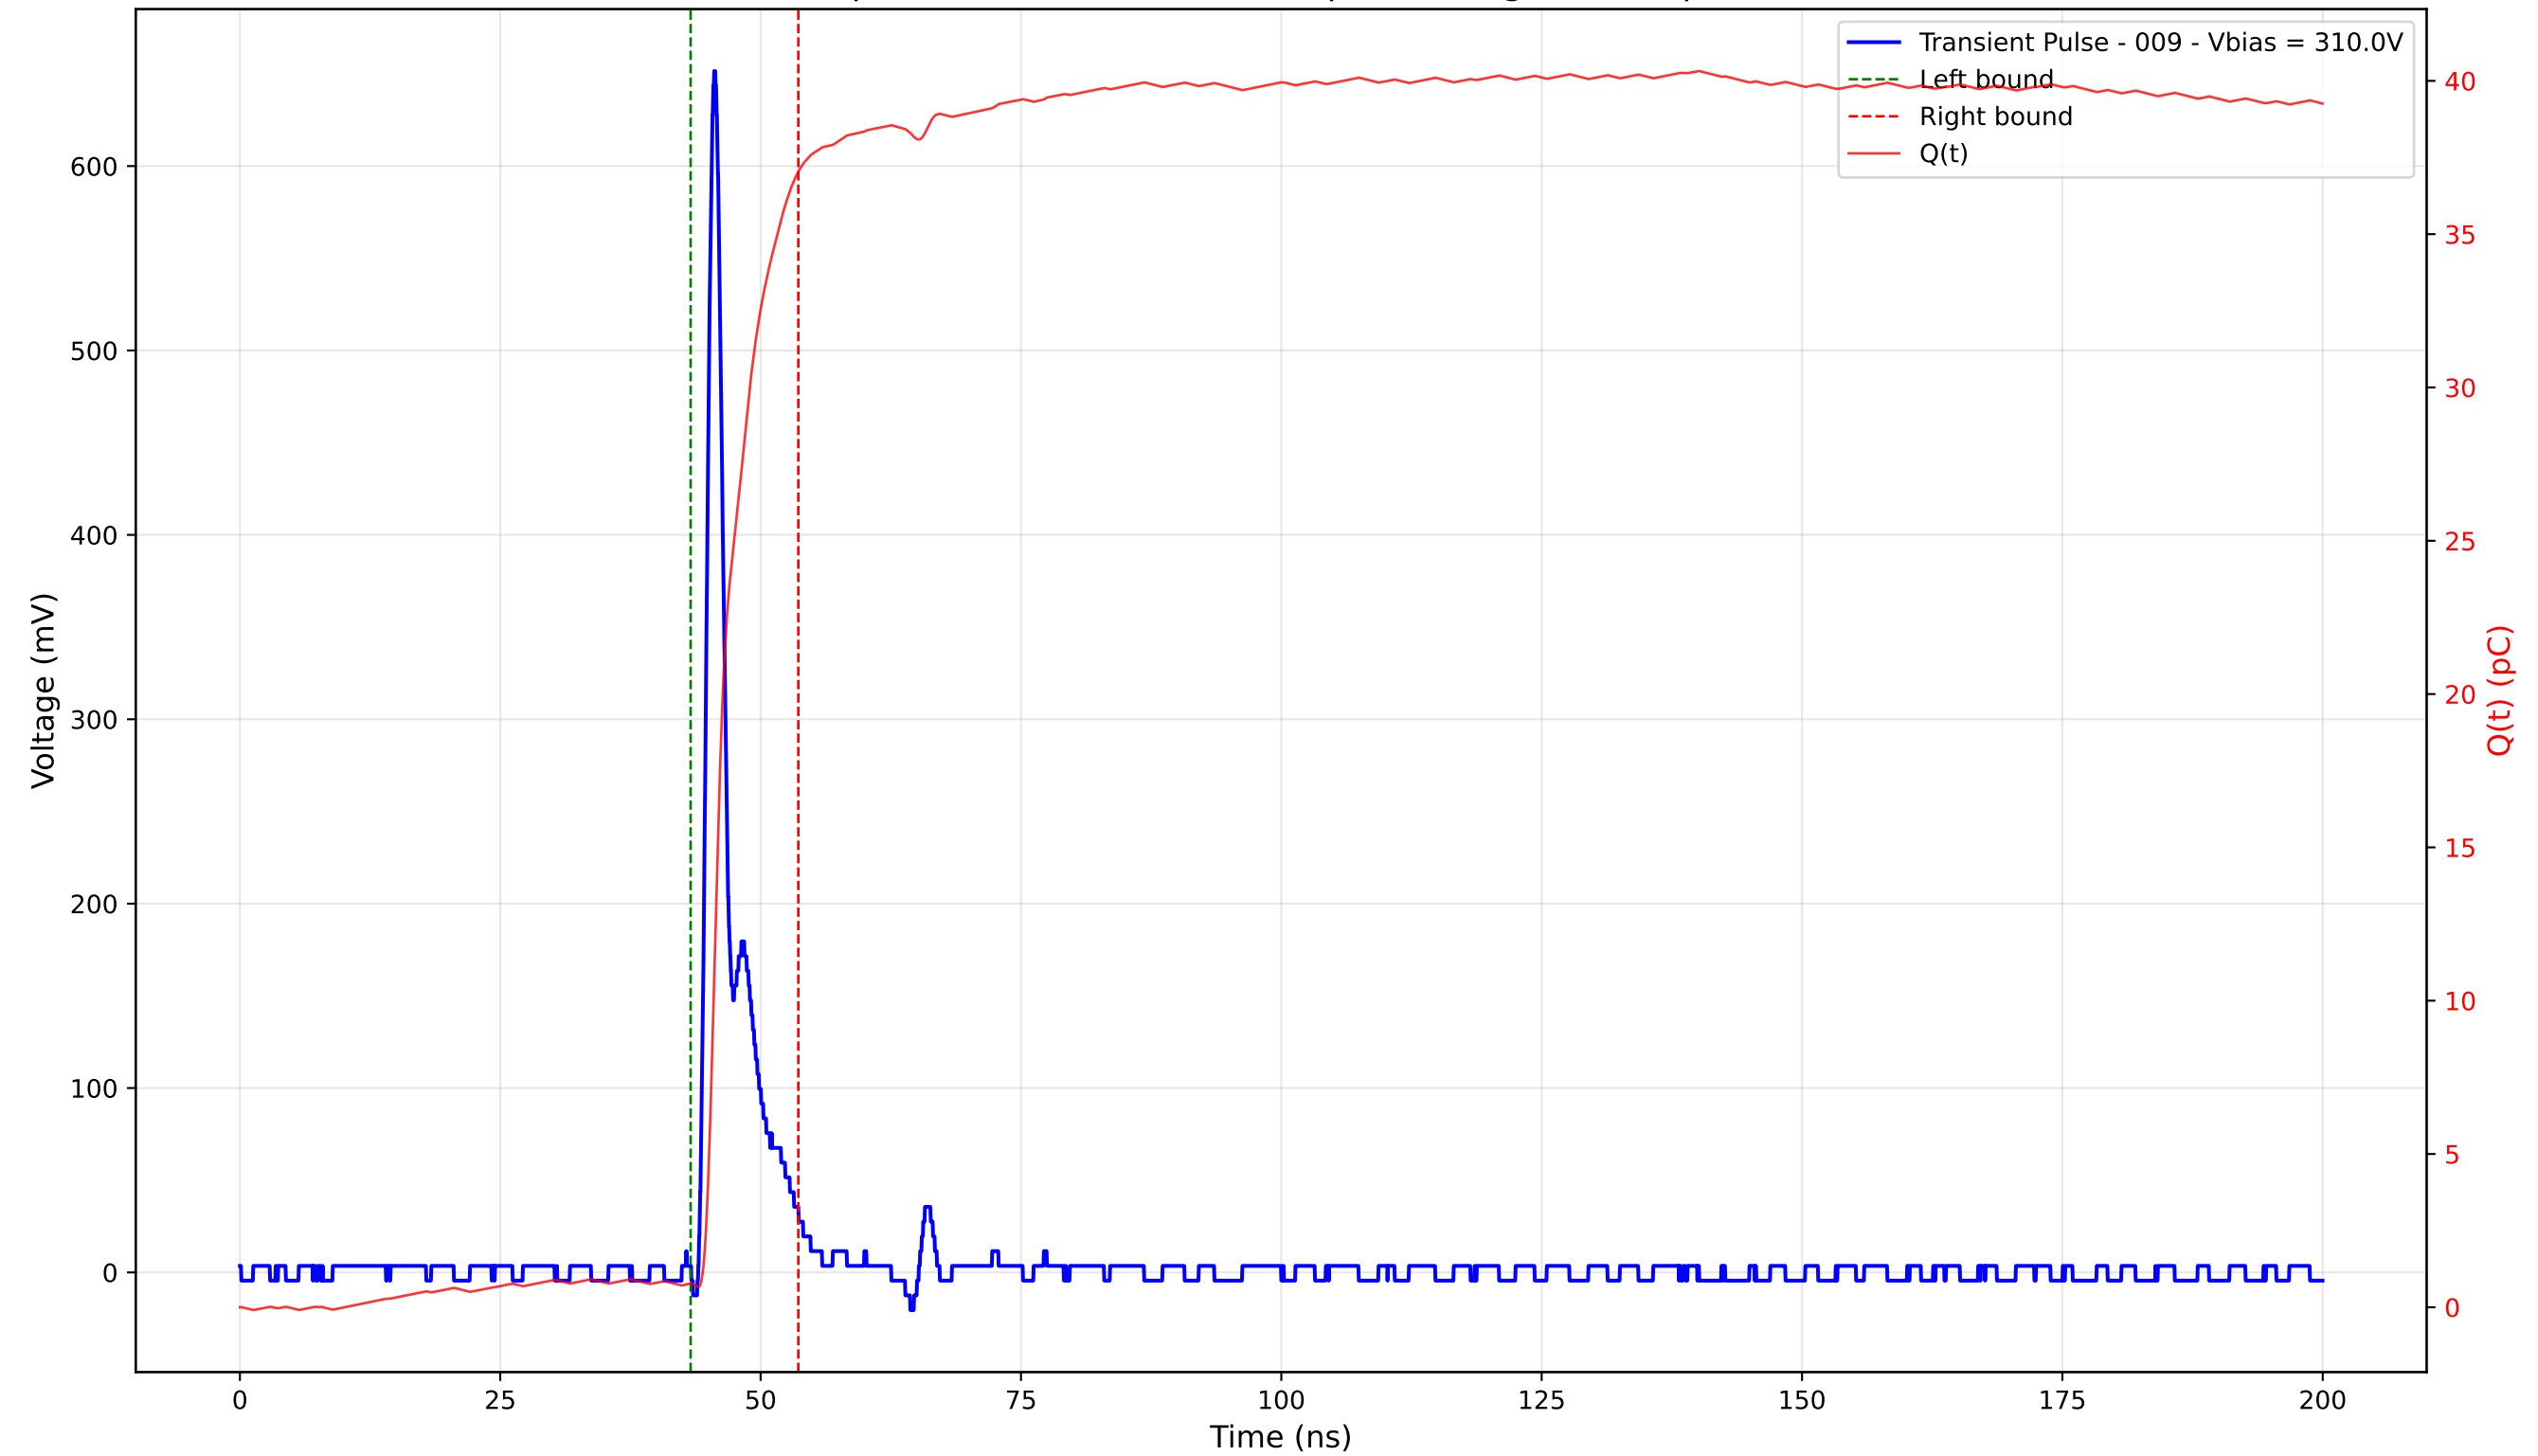


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 36.07 pC - Rise Time: 0.97 ns

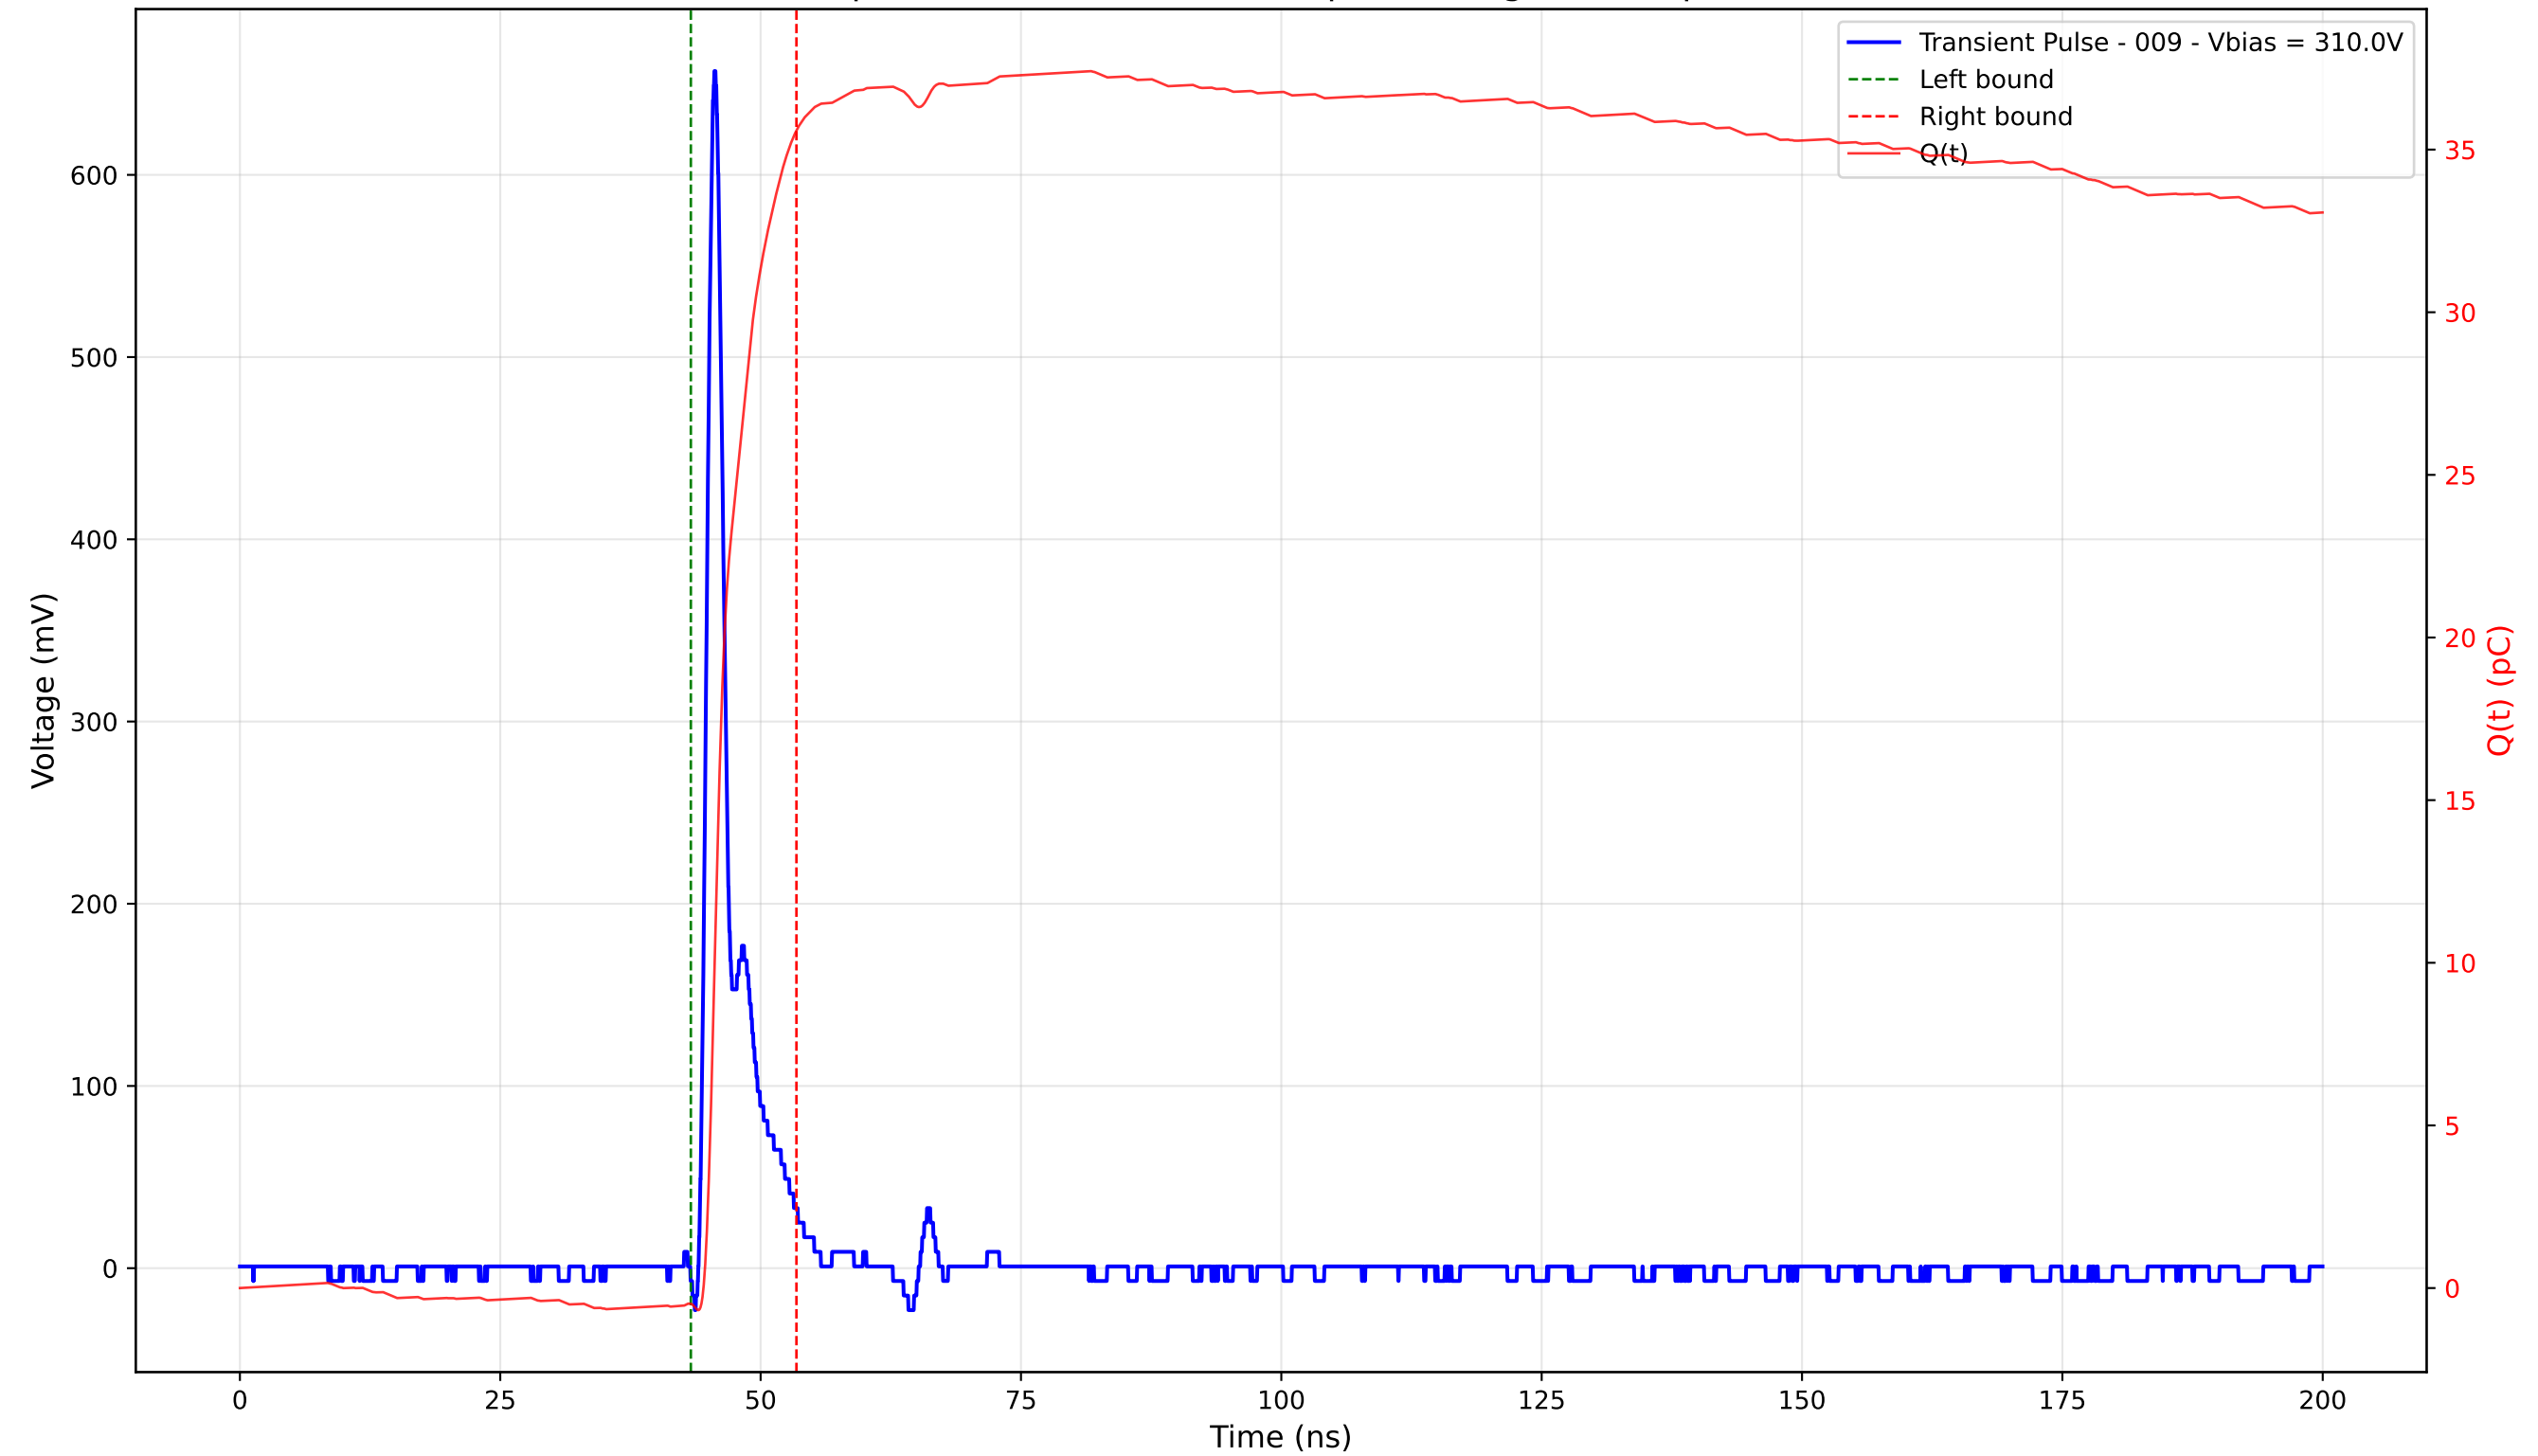


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 35.70 pC - Rise Time: 0.97 ns

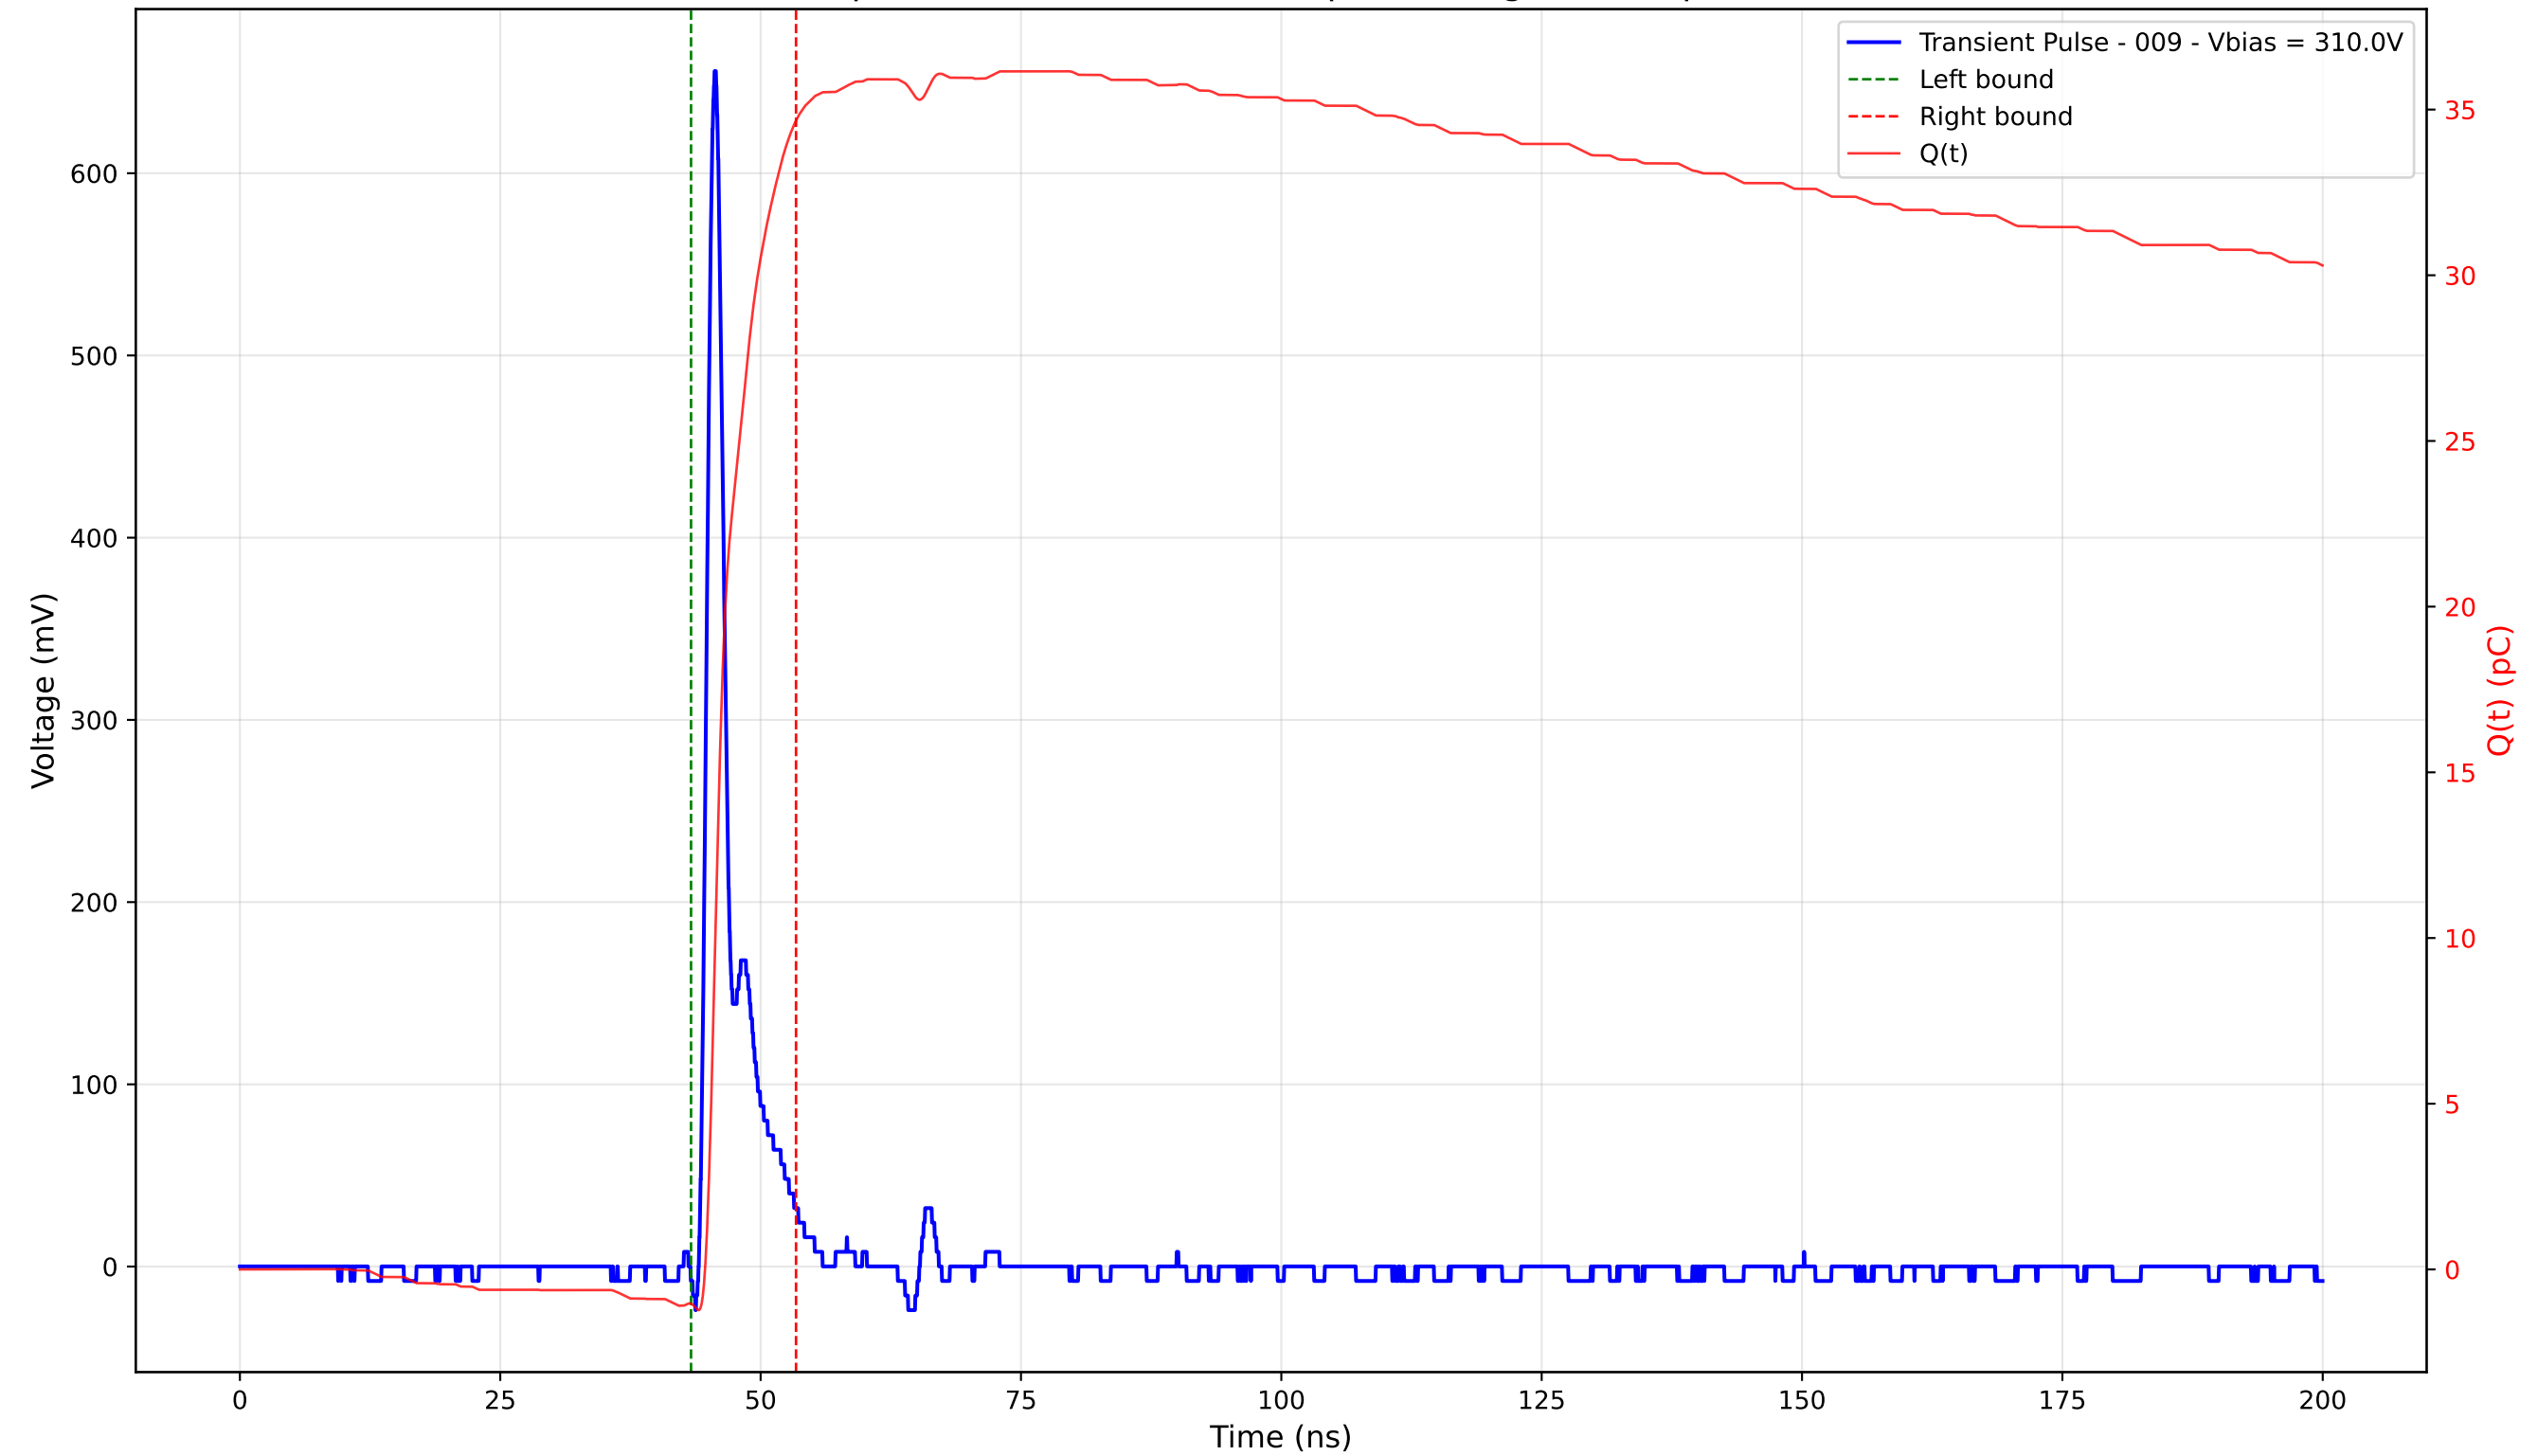


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 36.13 pC - Rise Time: 1.01 ns

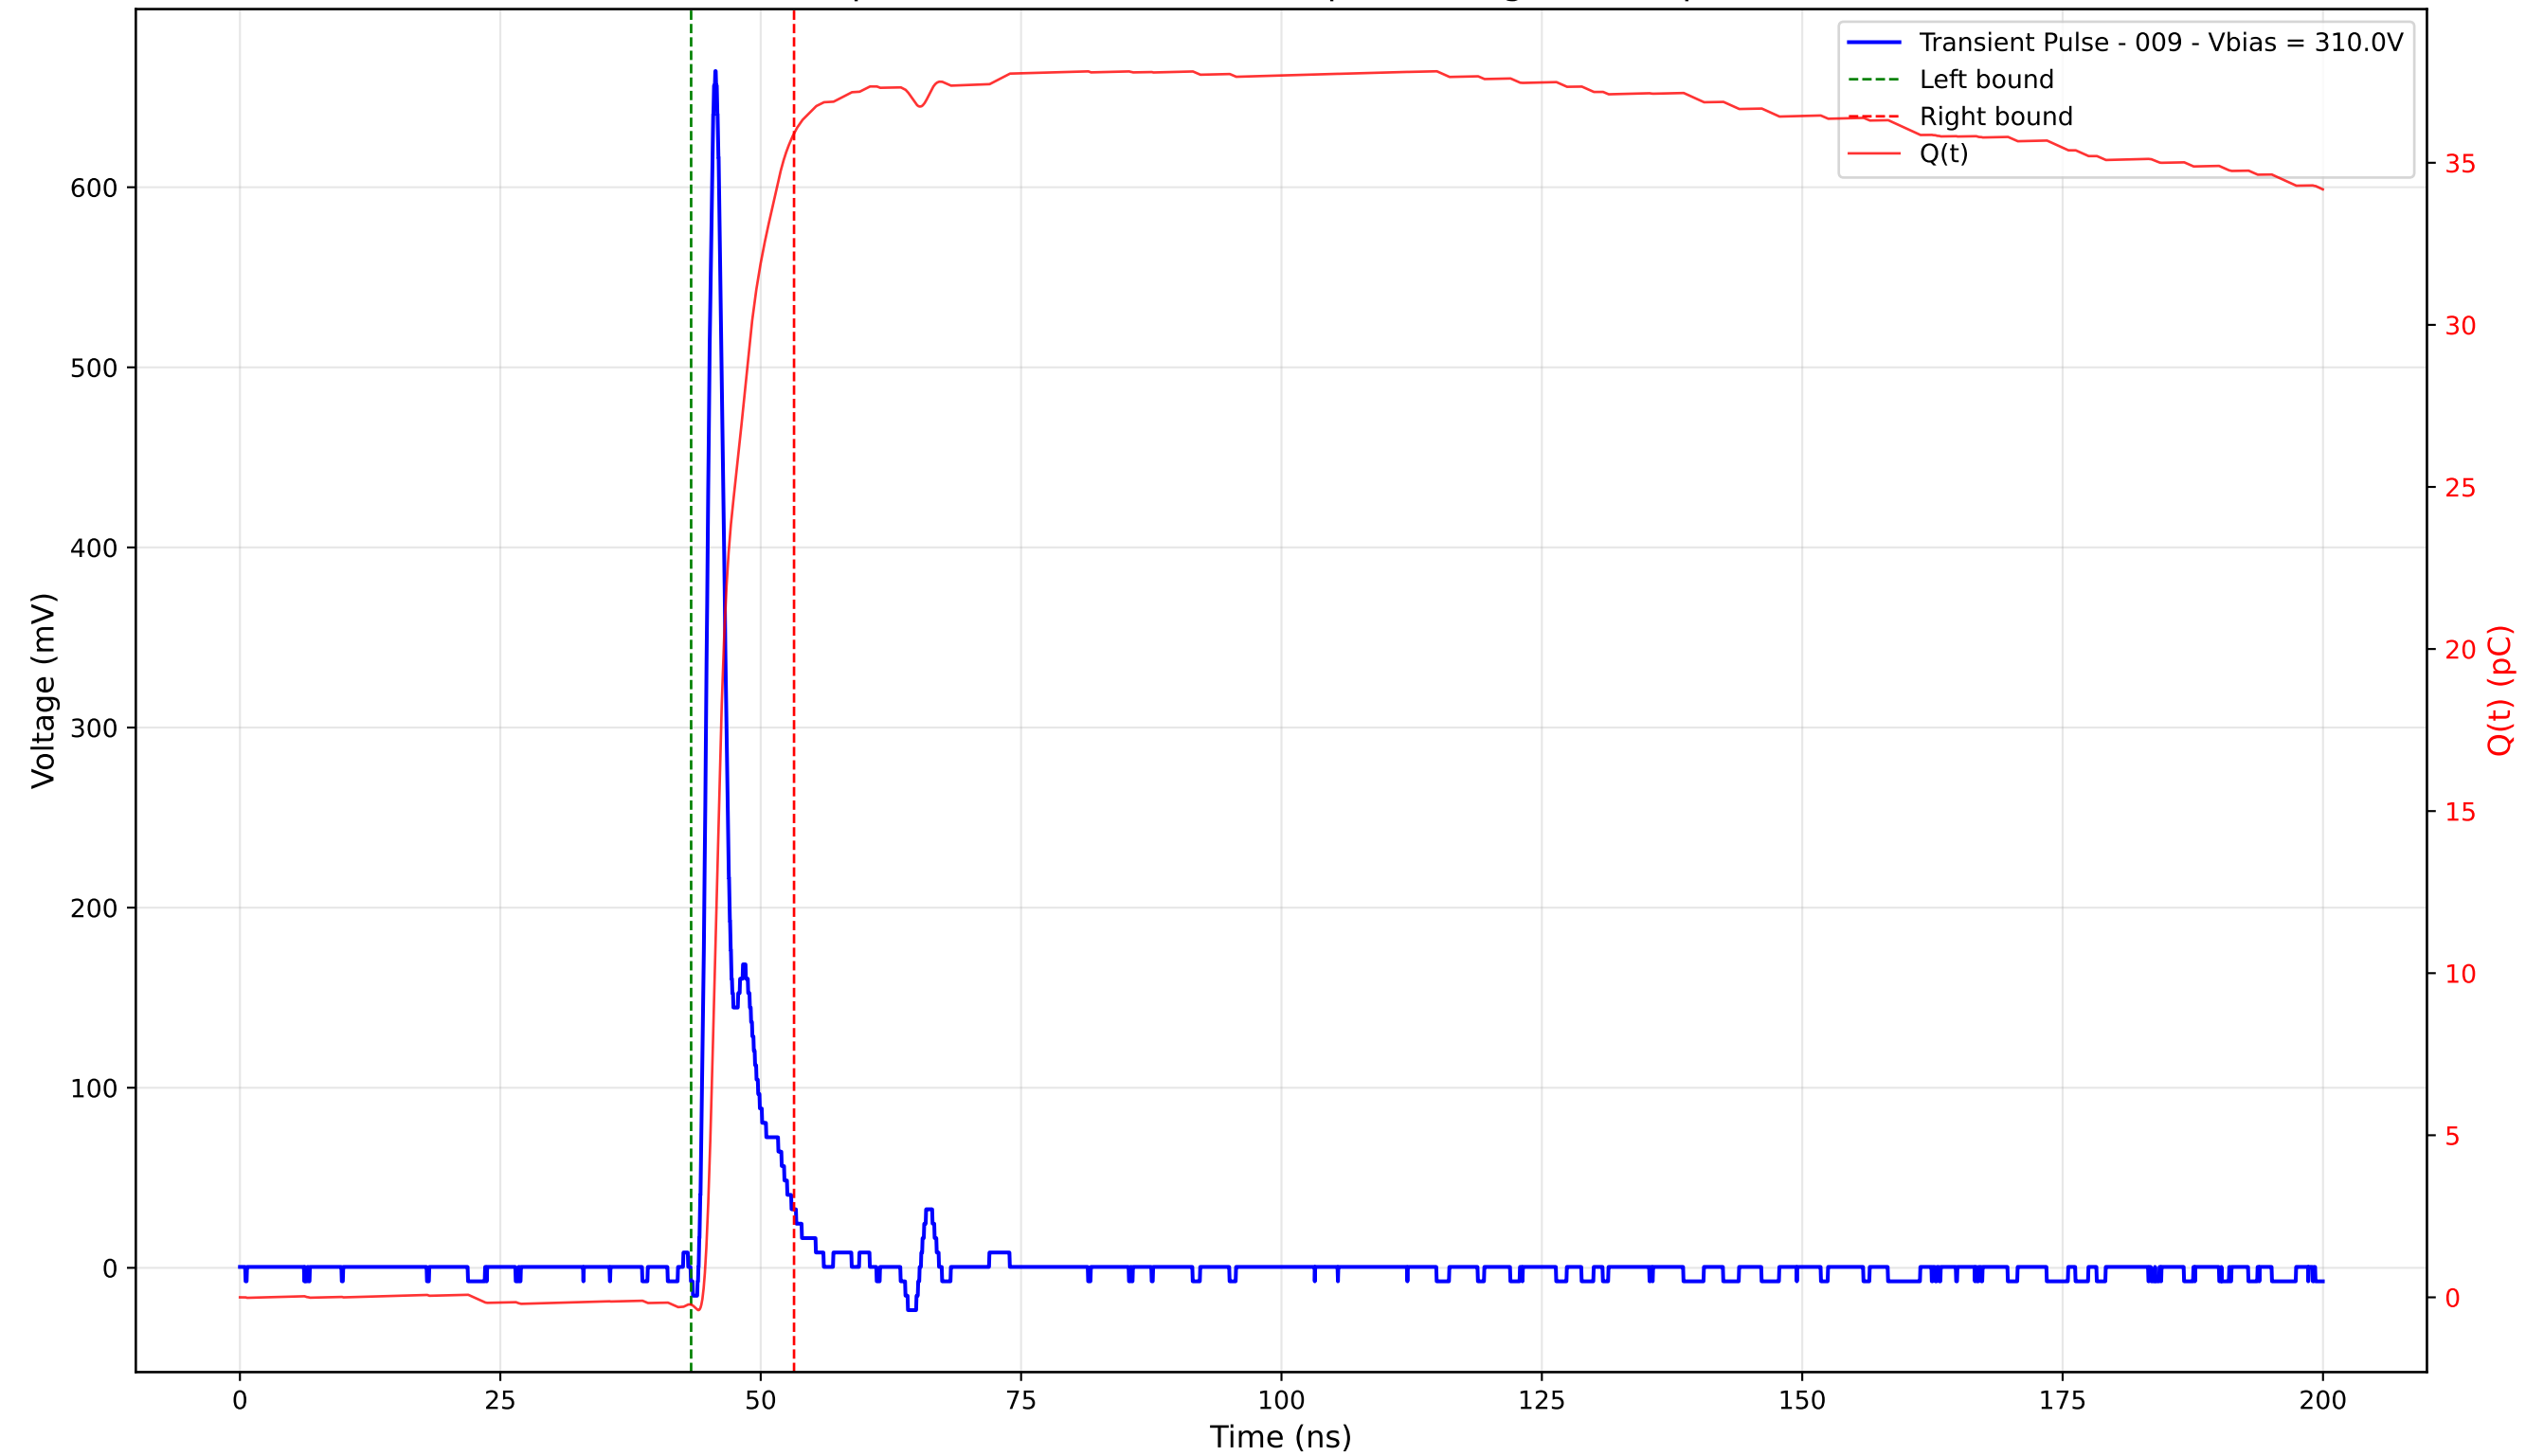


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 36.30 pC - Rise Time: 1.01 ns

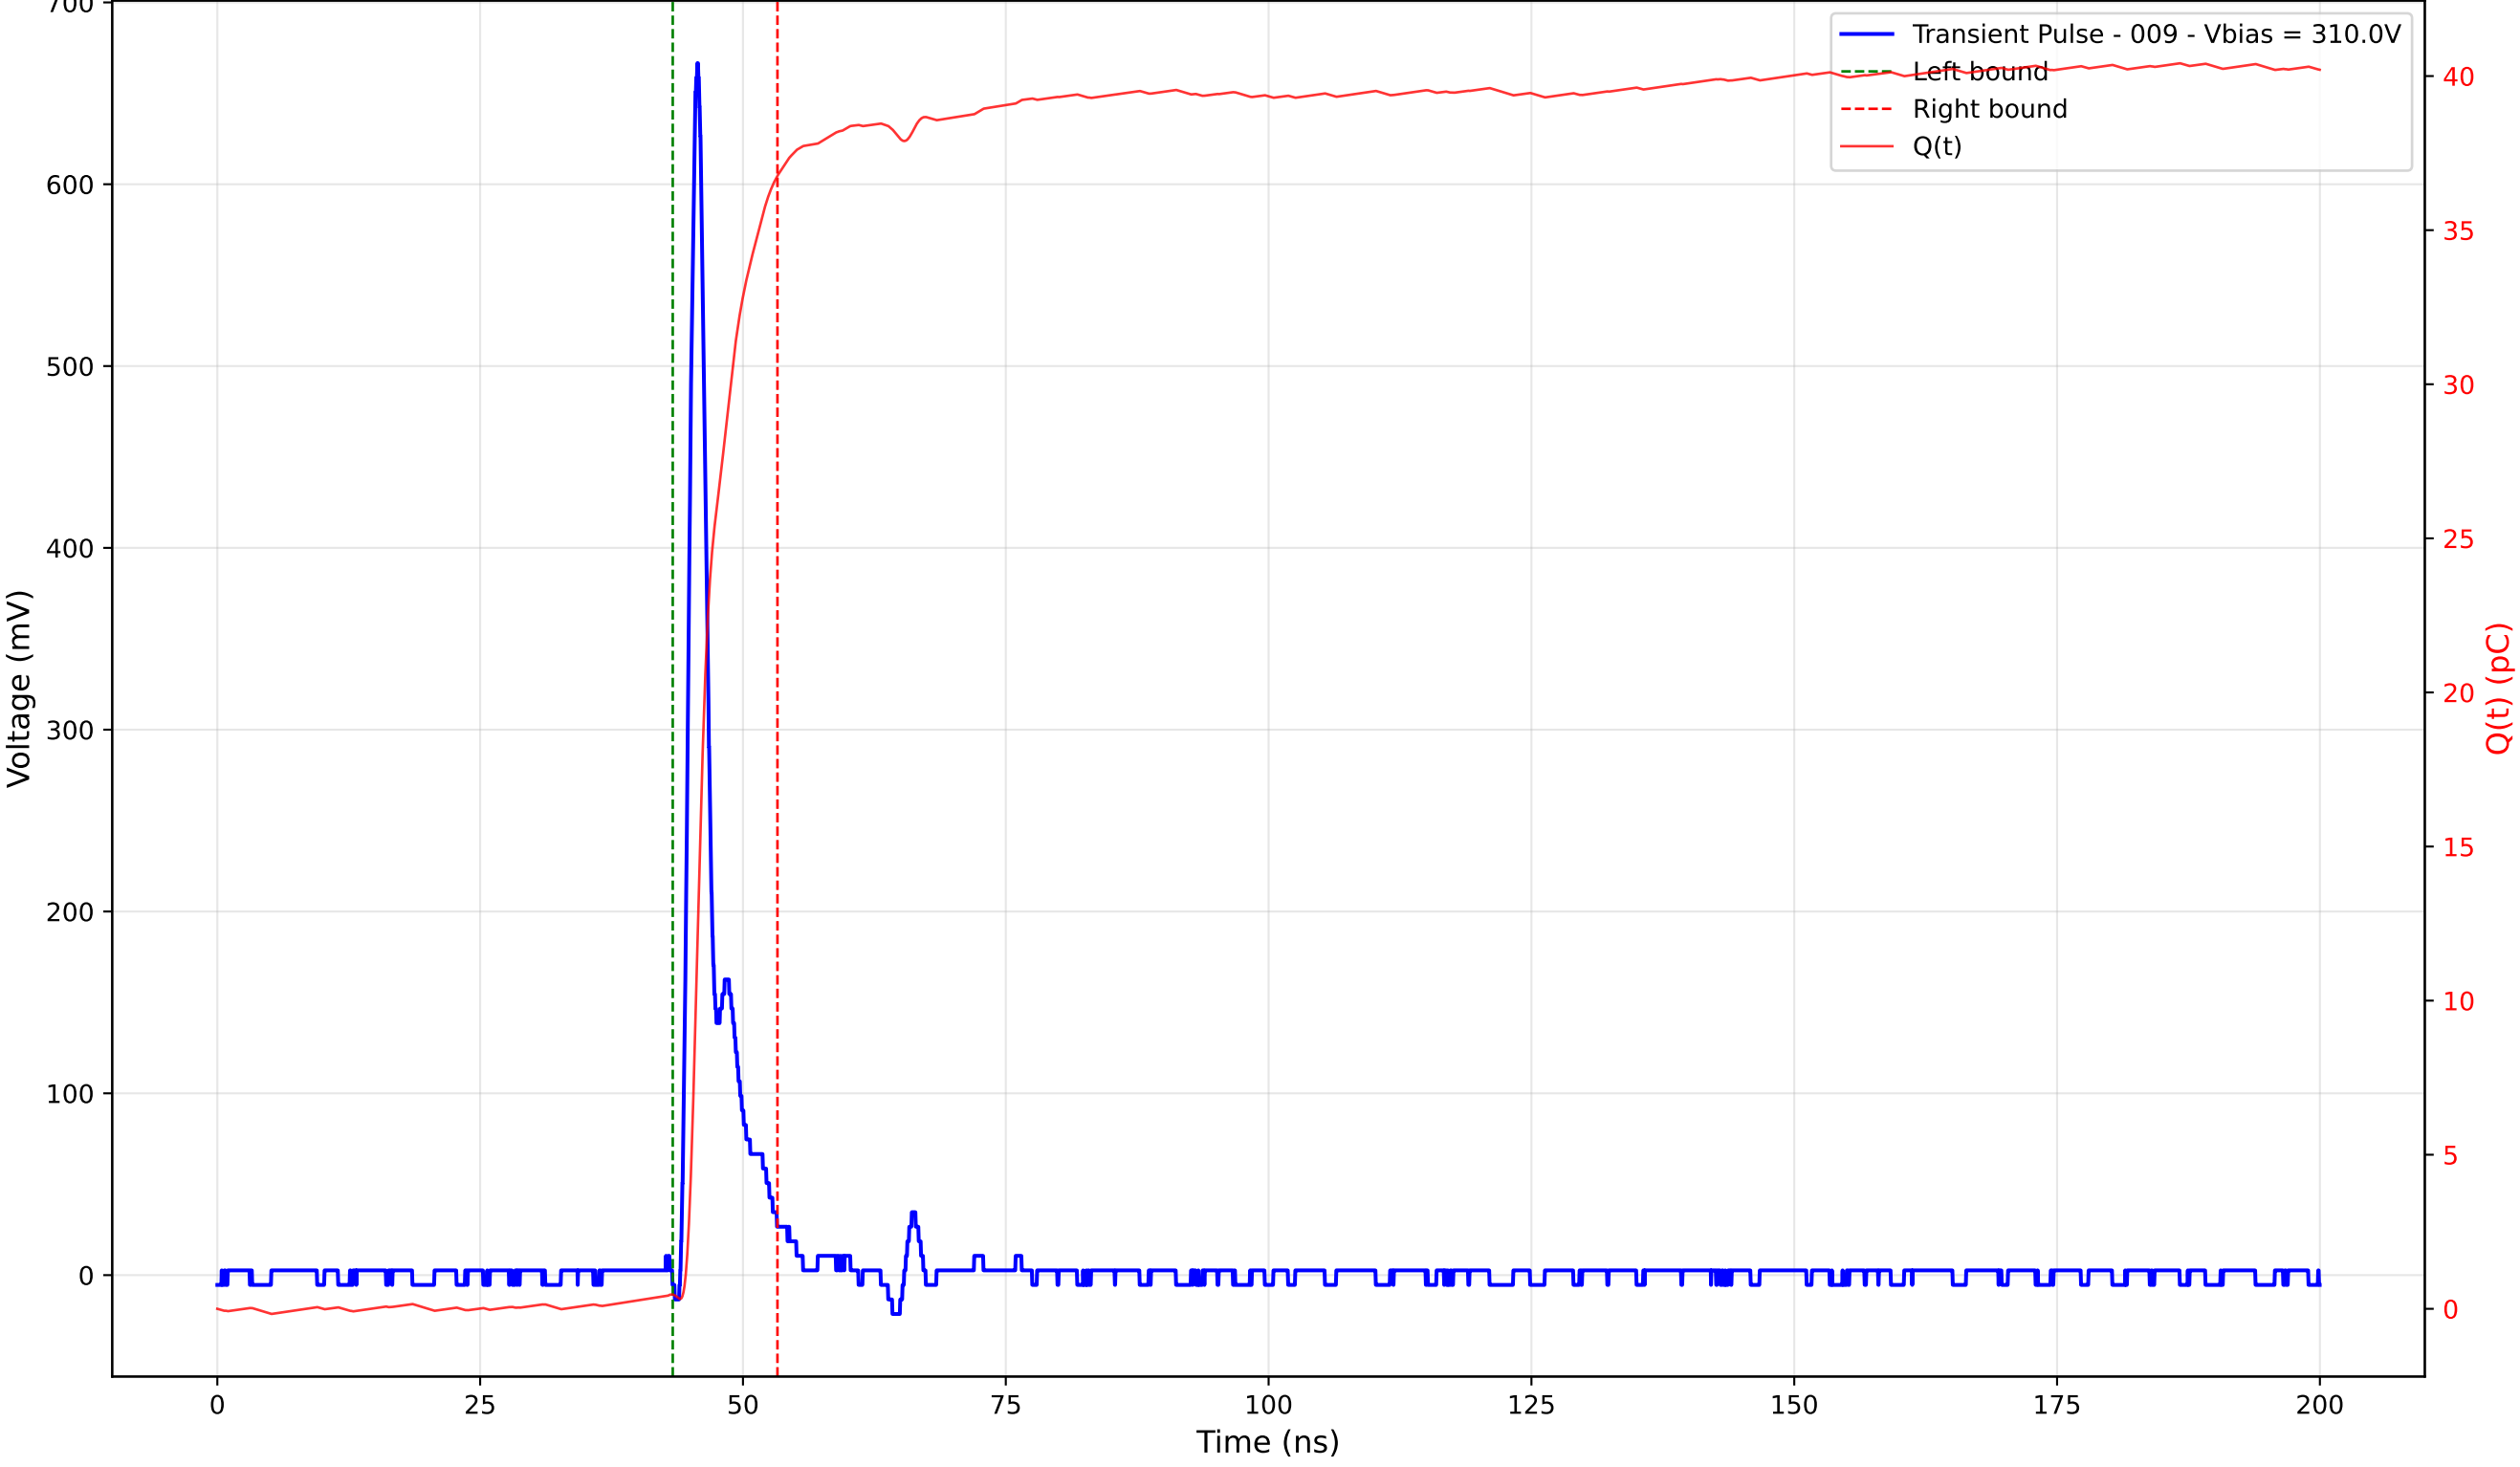


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 36.37 pC - Rise Time: 1.02 ns

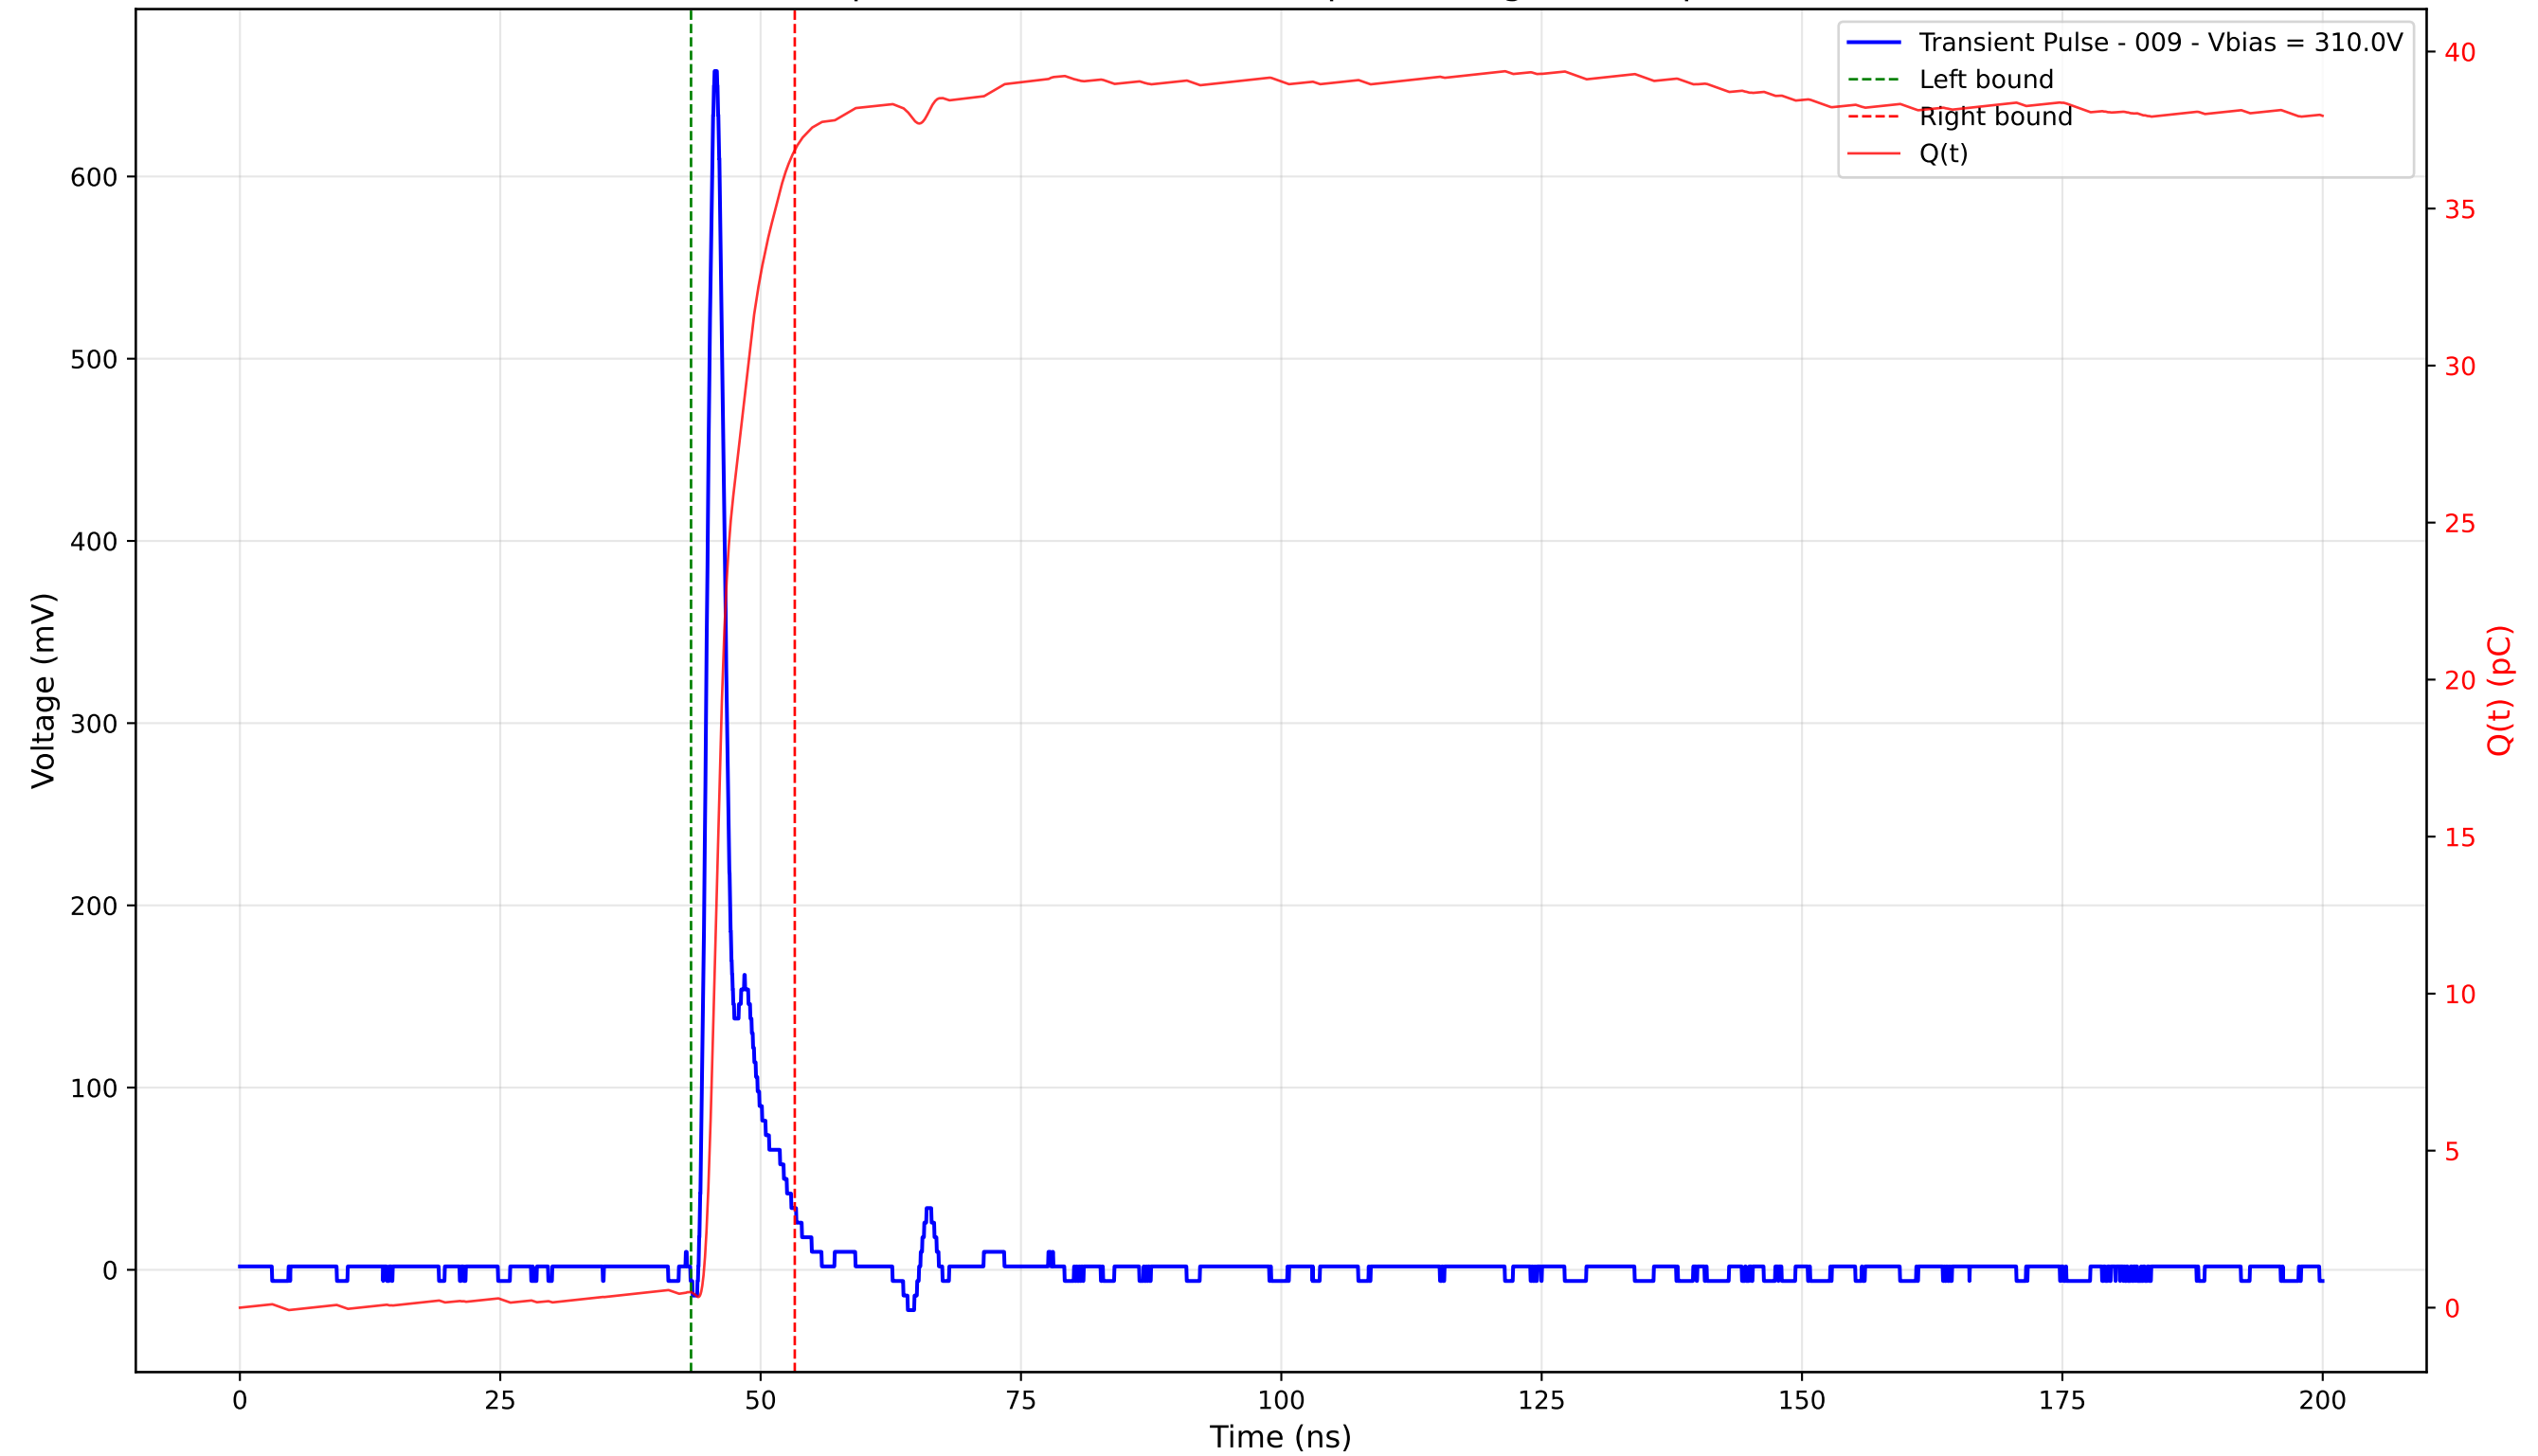


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 35.99 pC - Rise Time: 1.02 ns

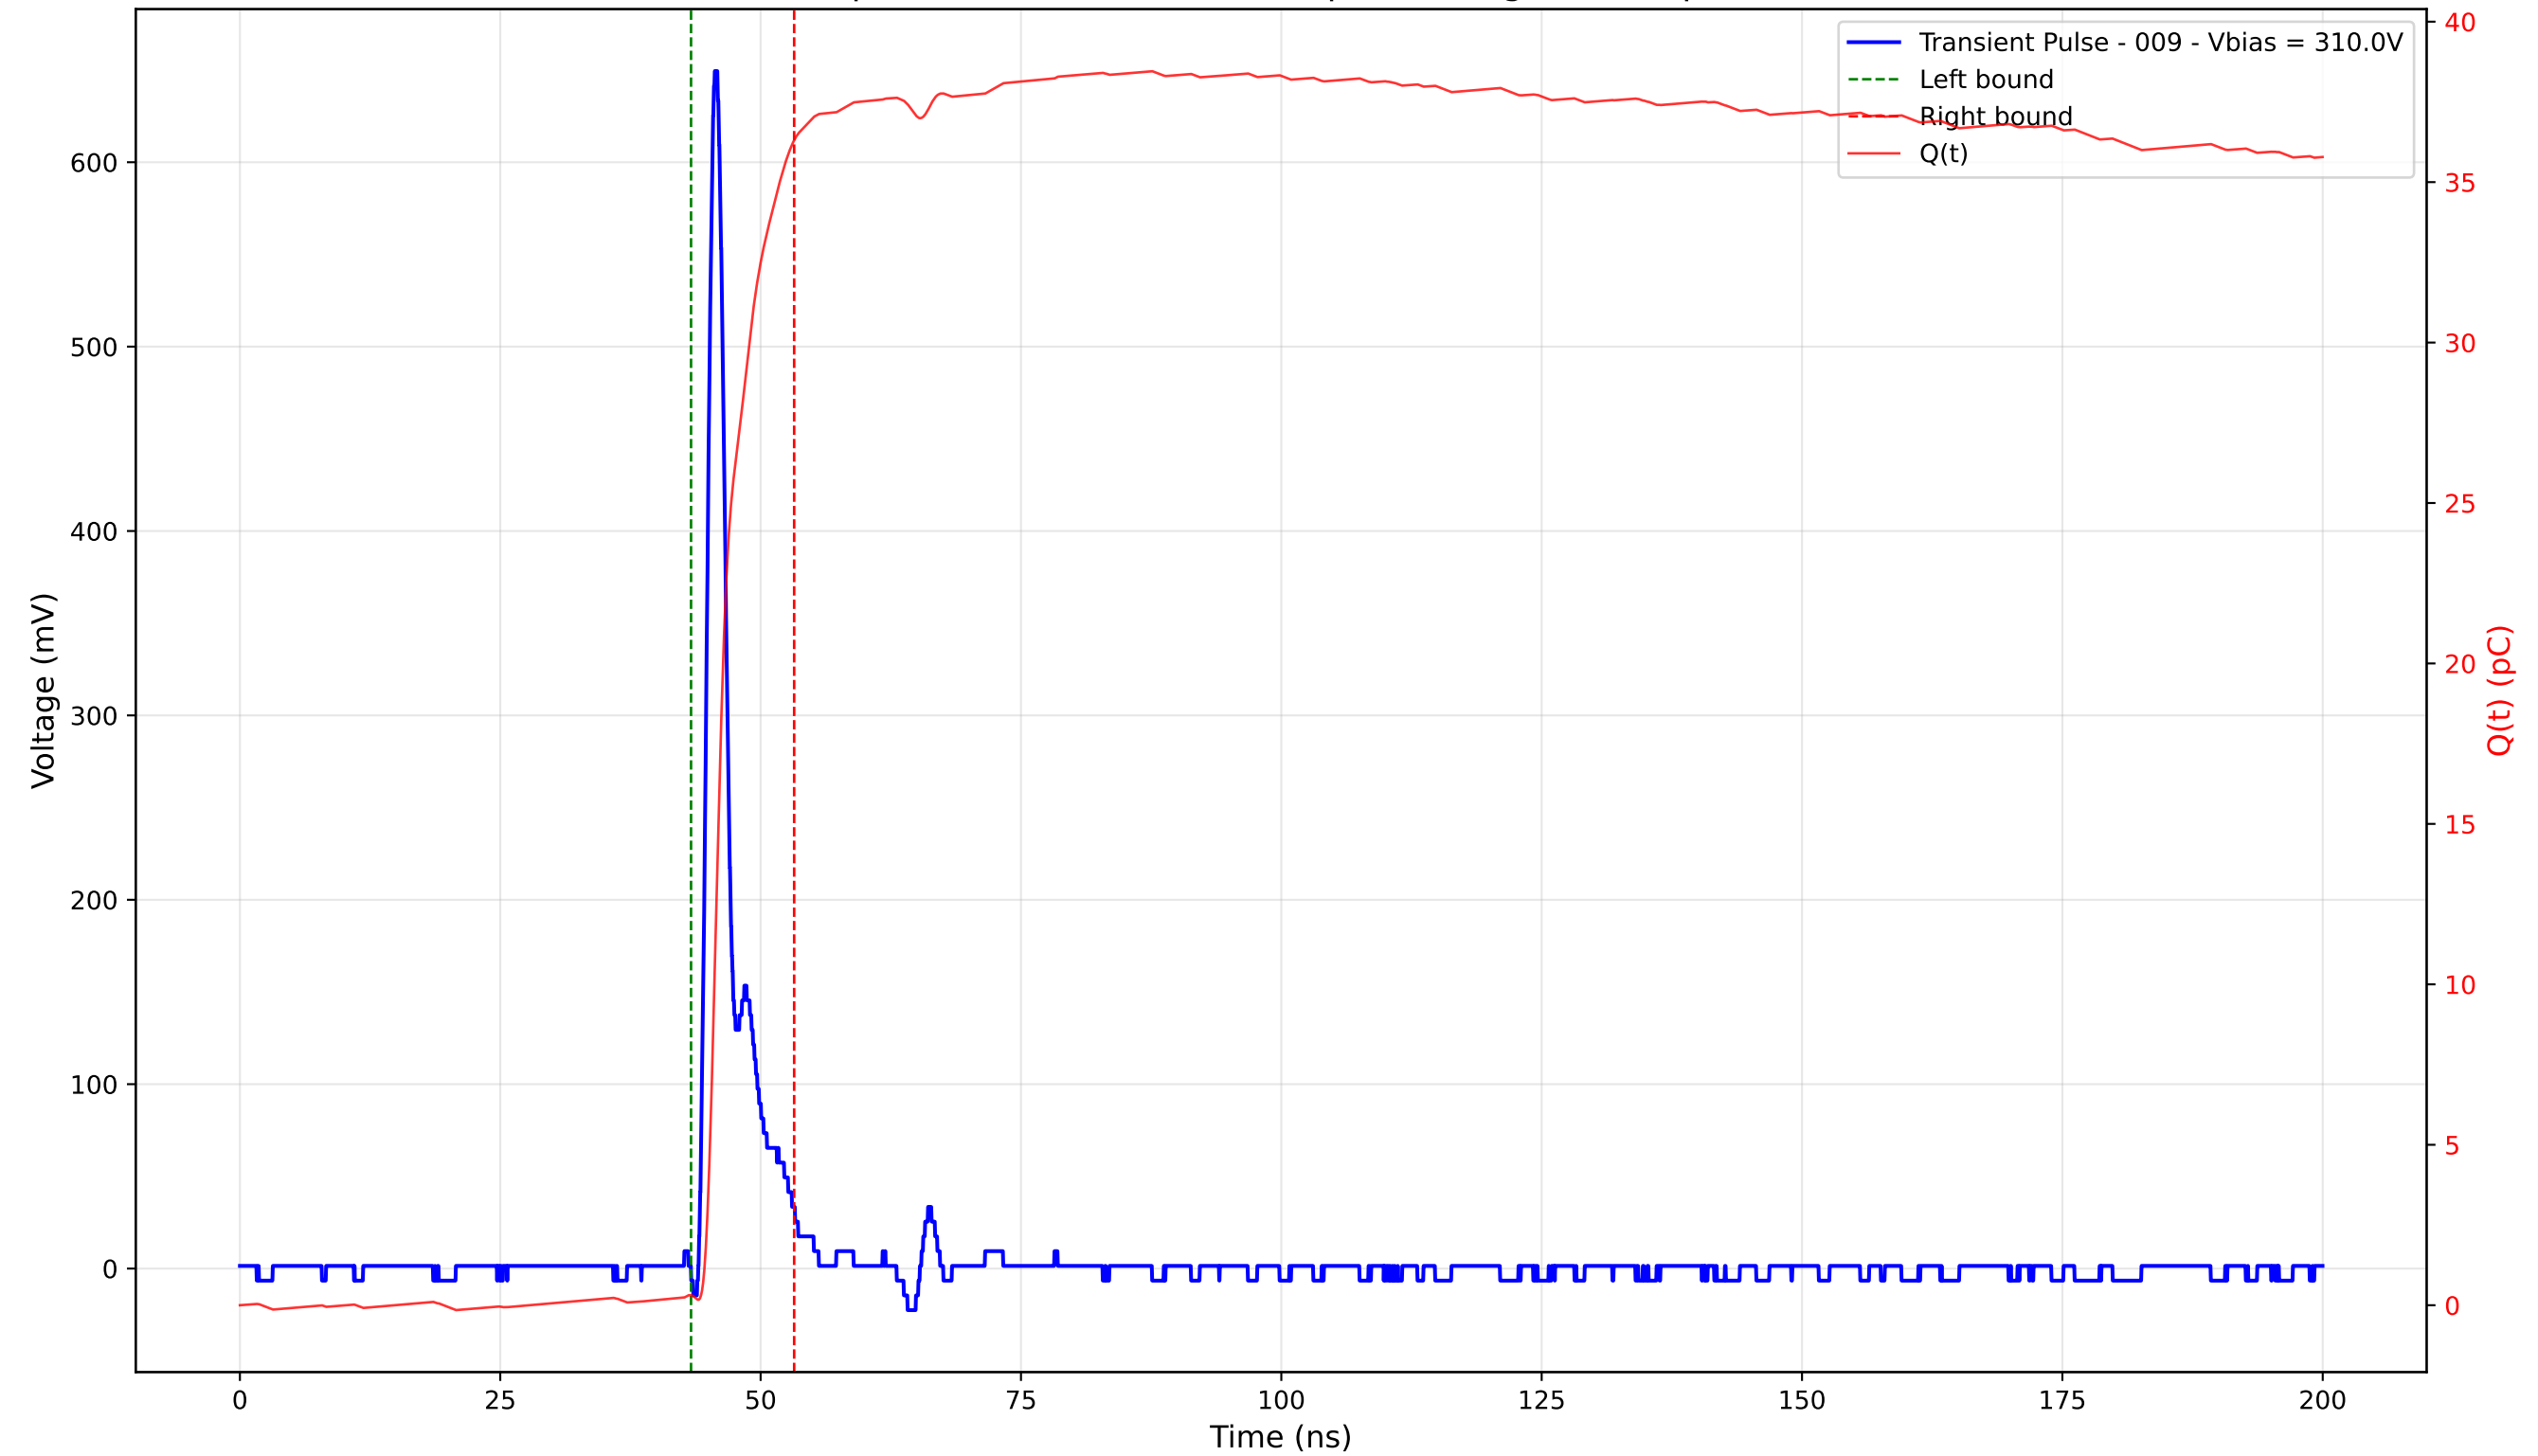


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 35.77 pC - Rise Time: 1.04 ns

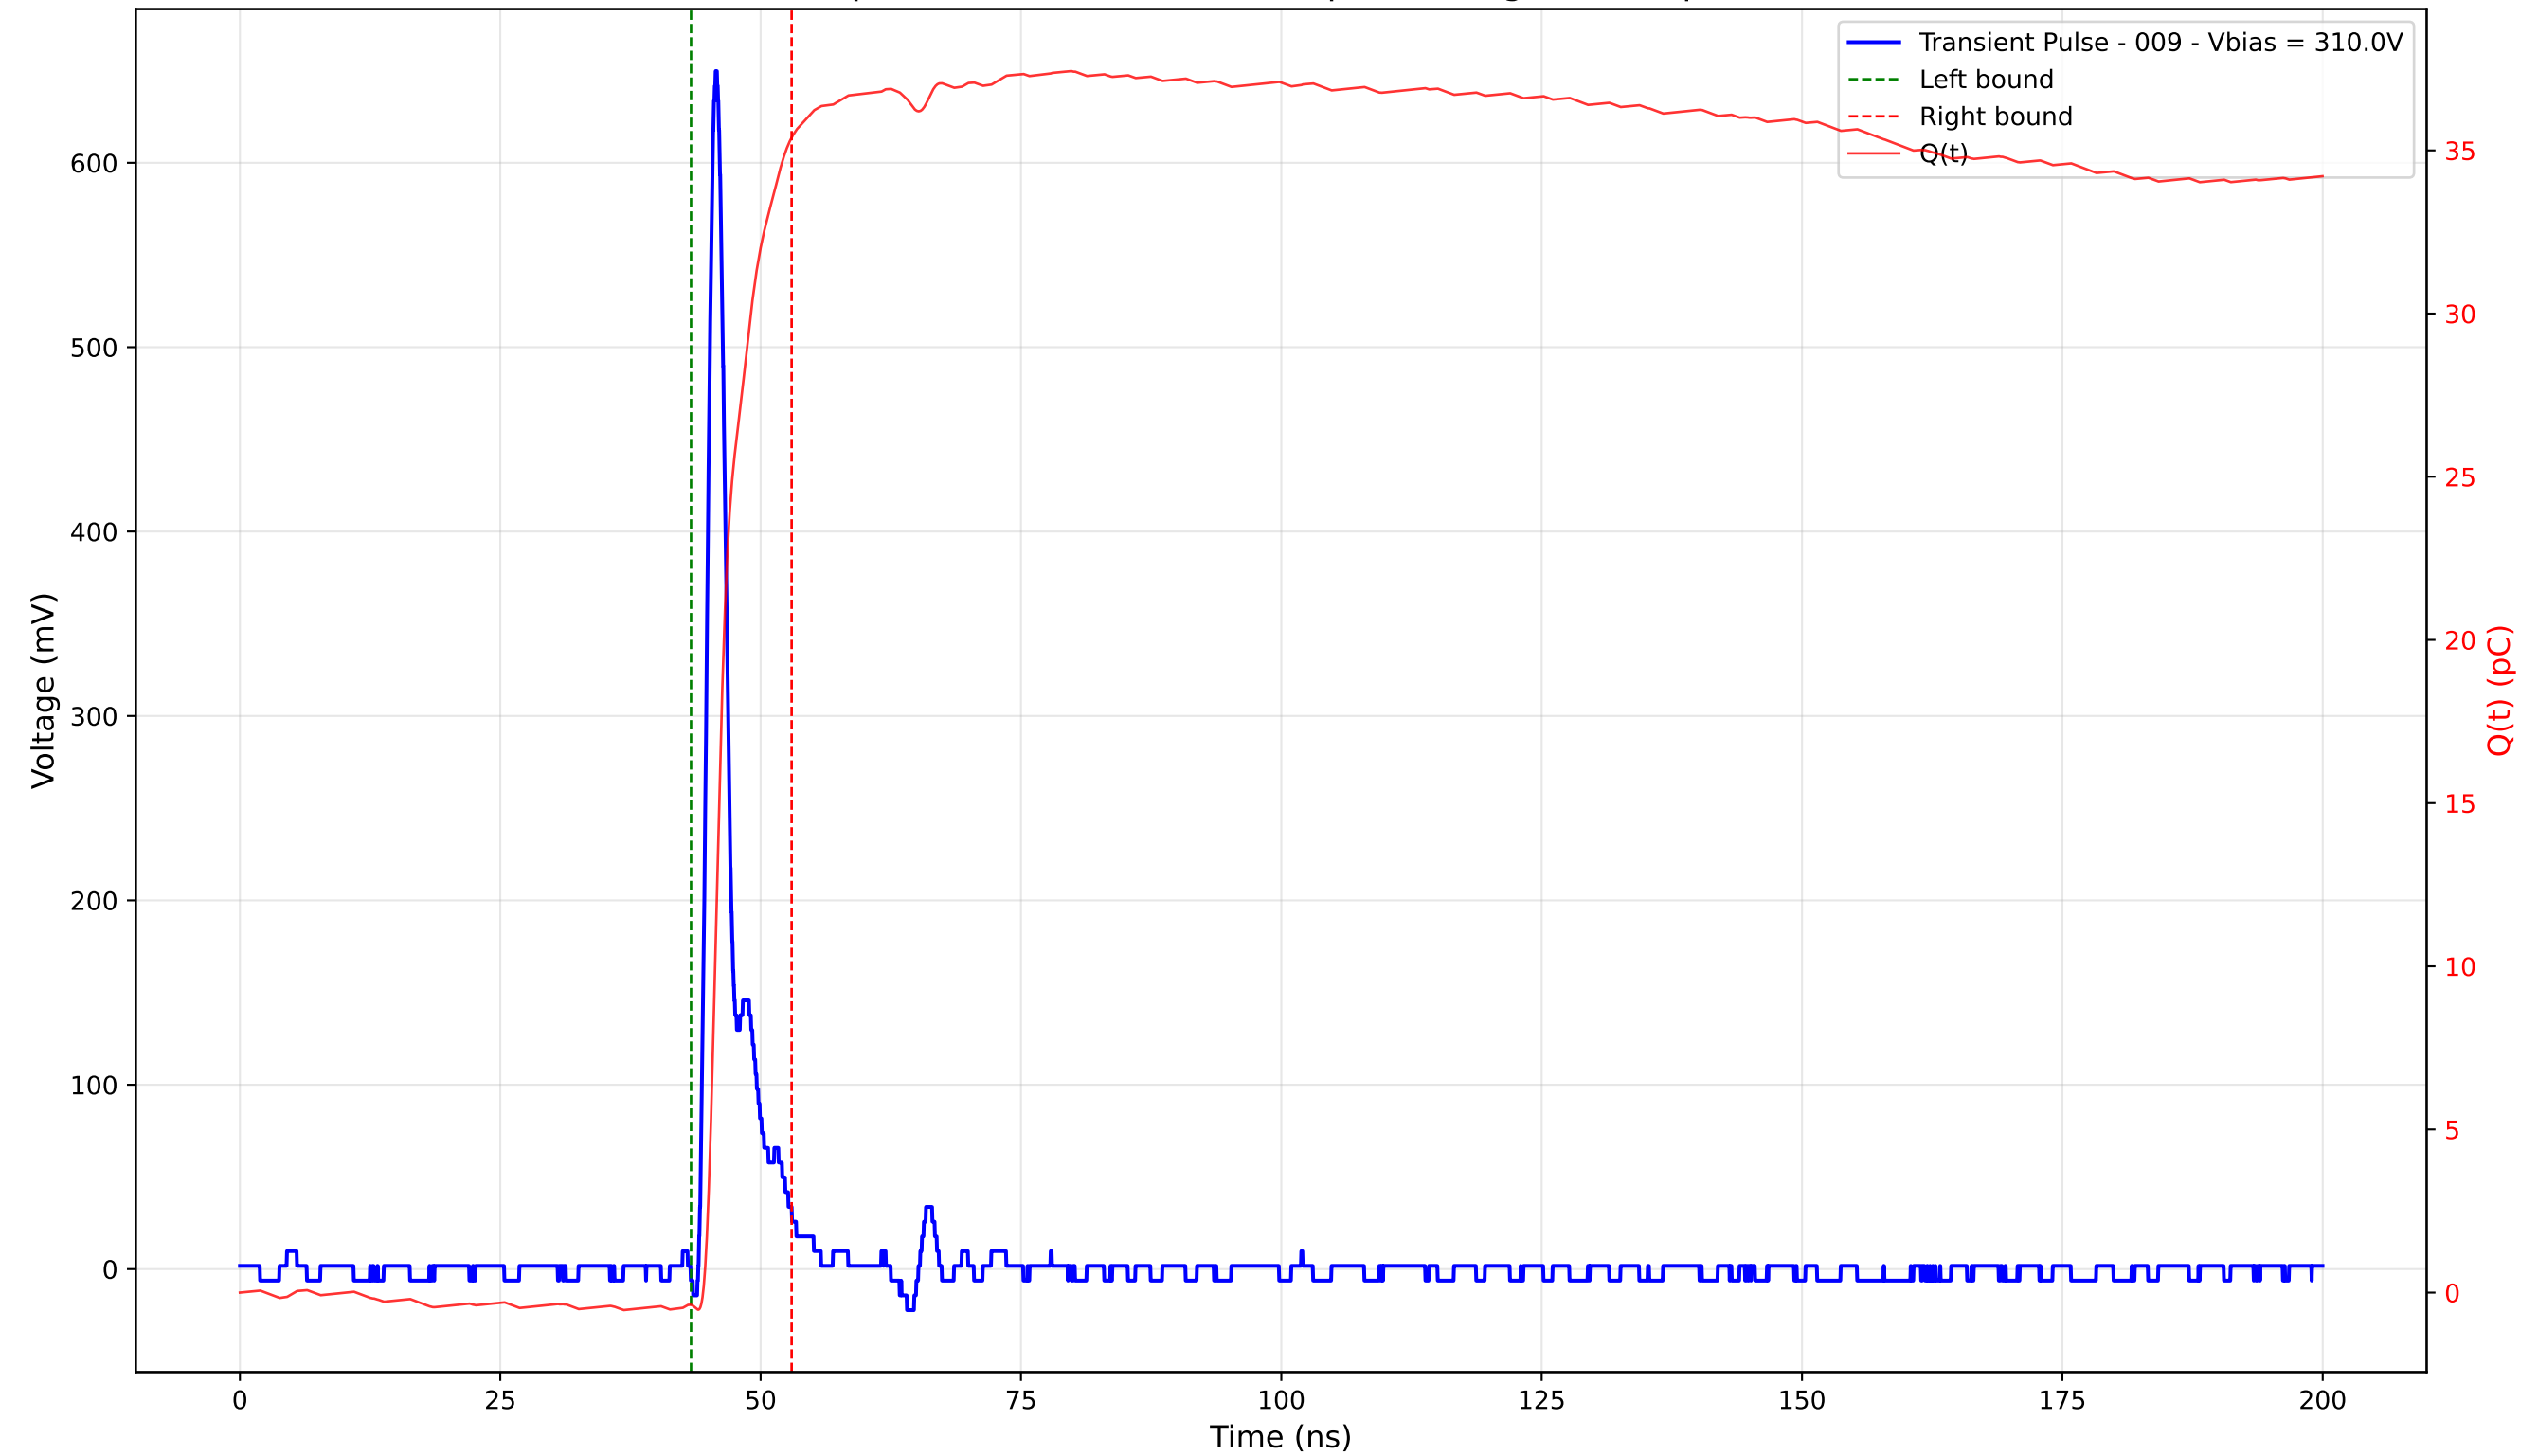


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 36.02 pC - Rise Time: 1.07 ns

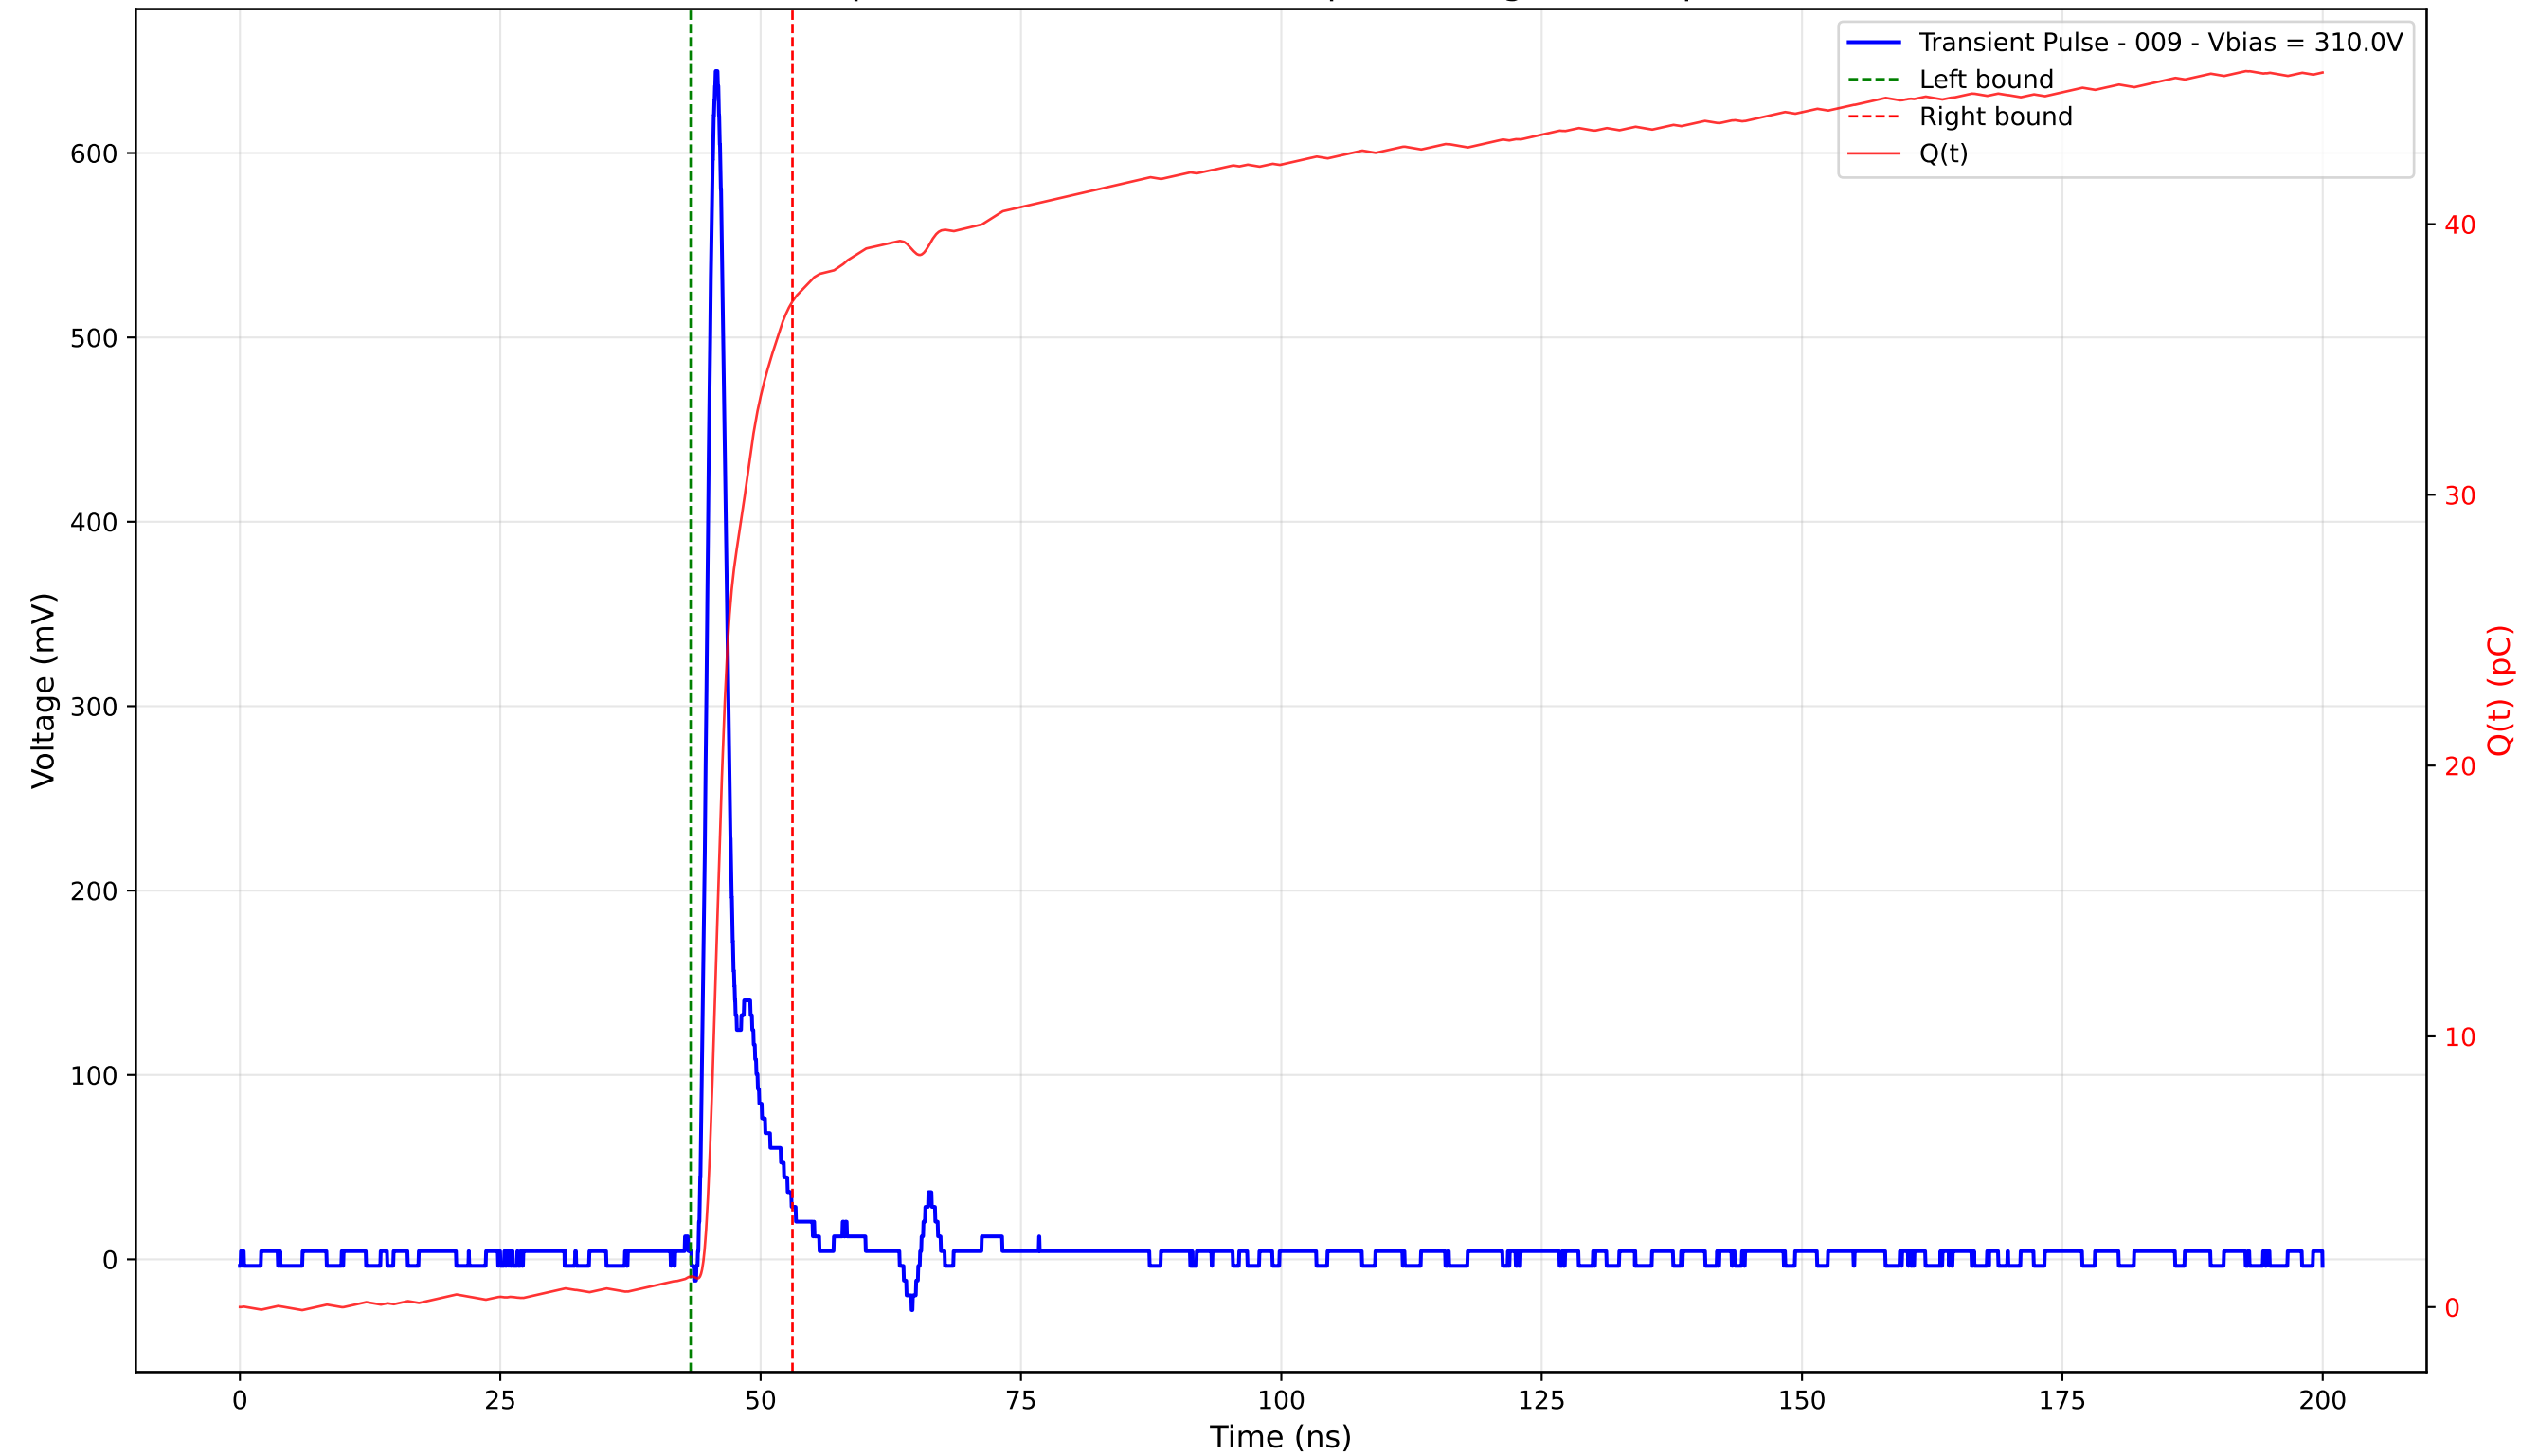


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 35.58 pC - Rise Time: 1.07 ns

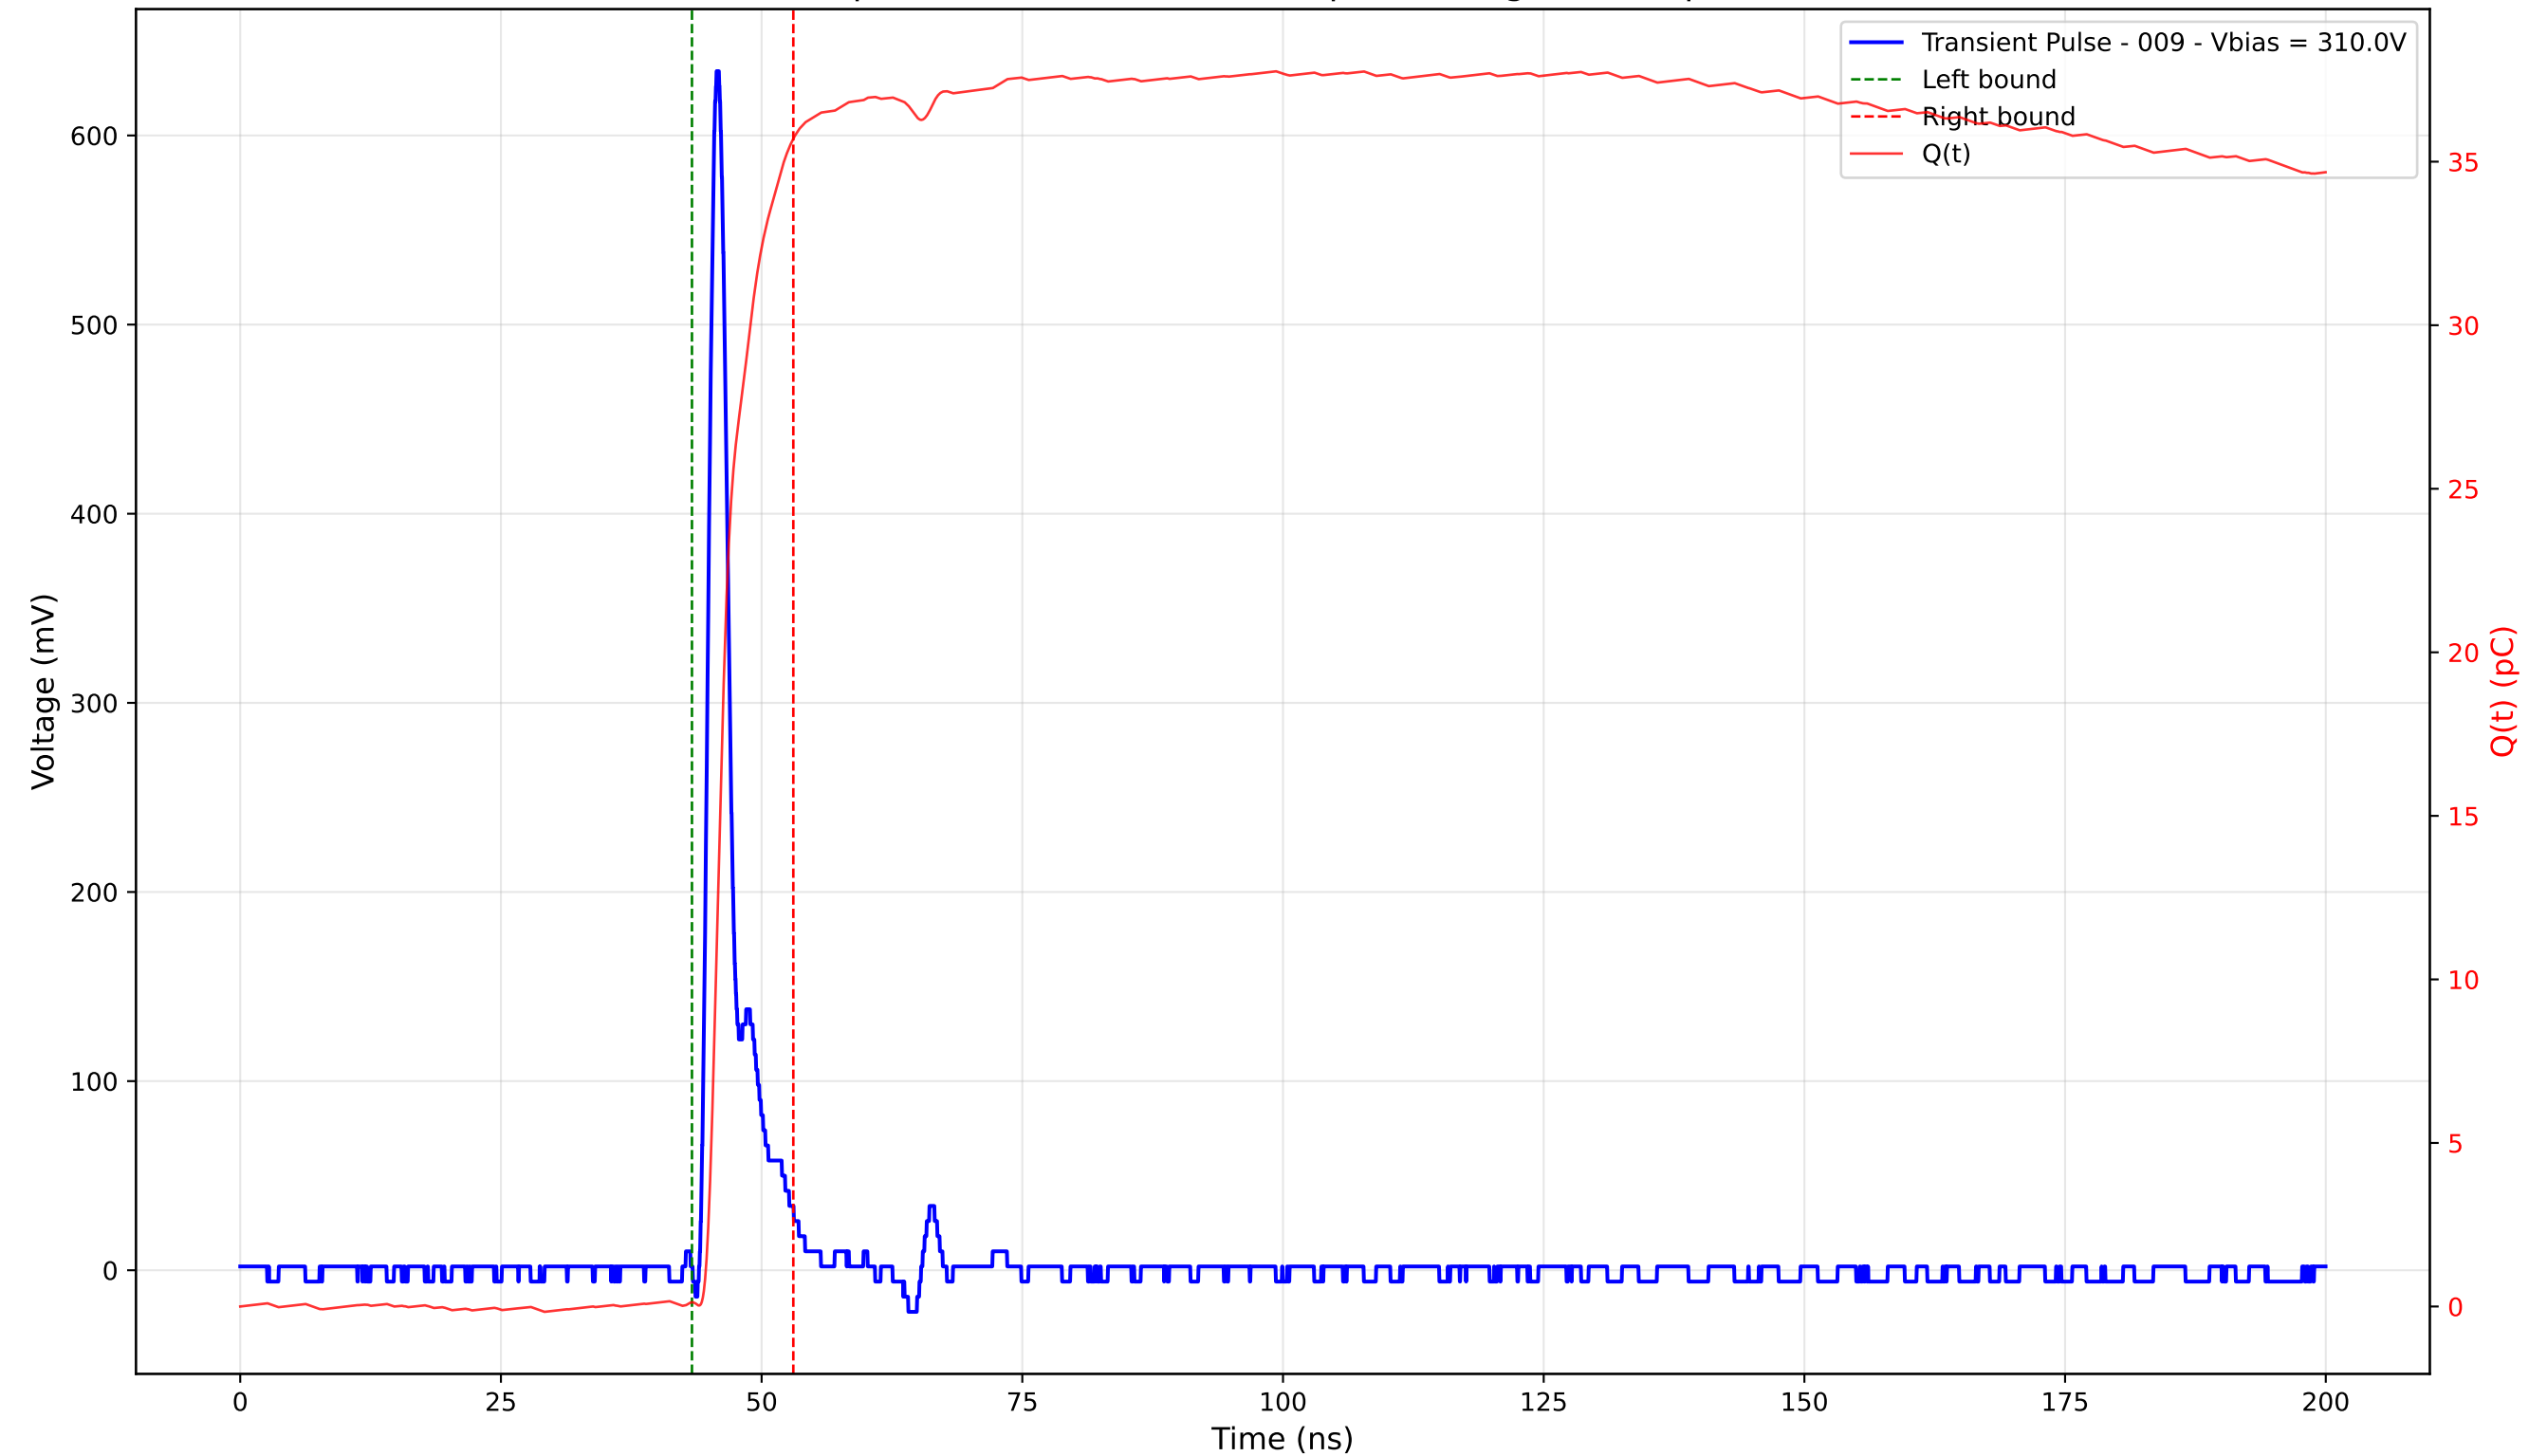


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 35.97 pC - Rise Time: 1.09 ns

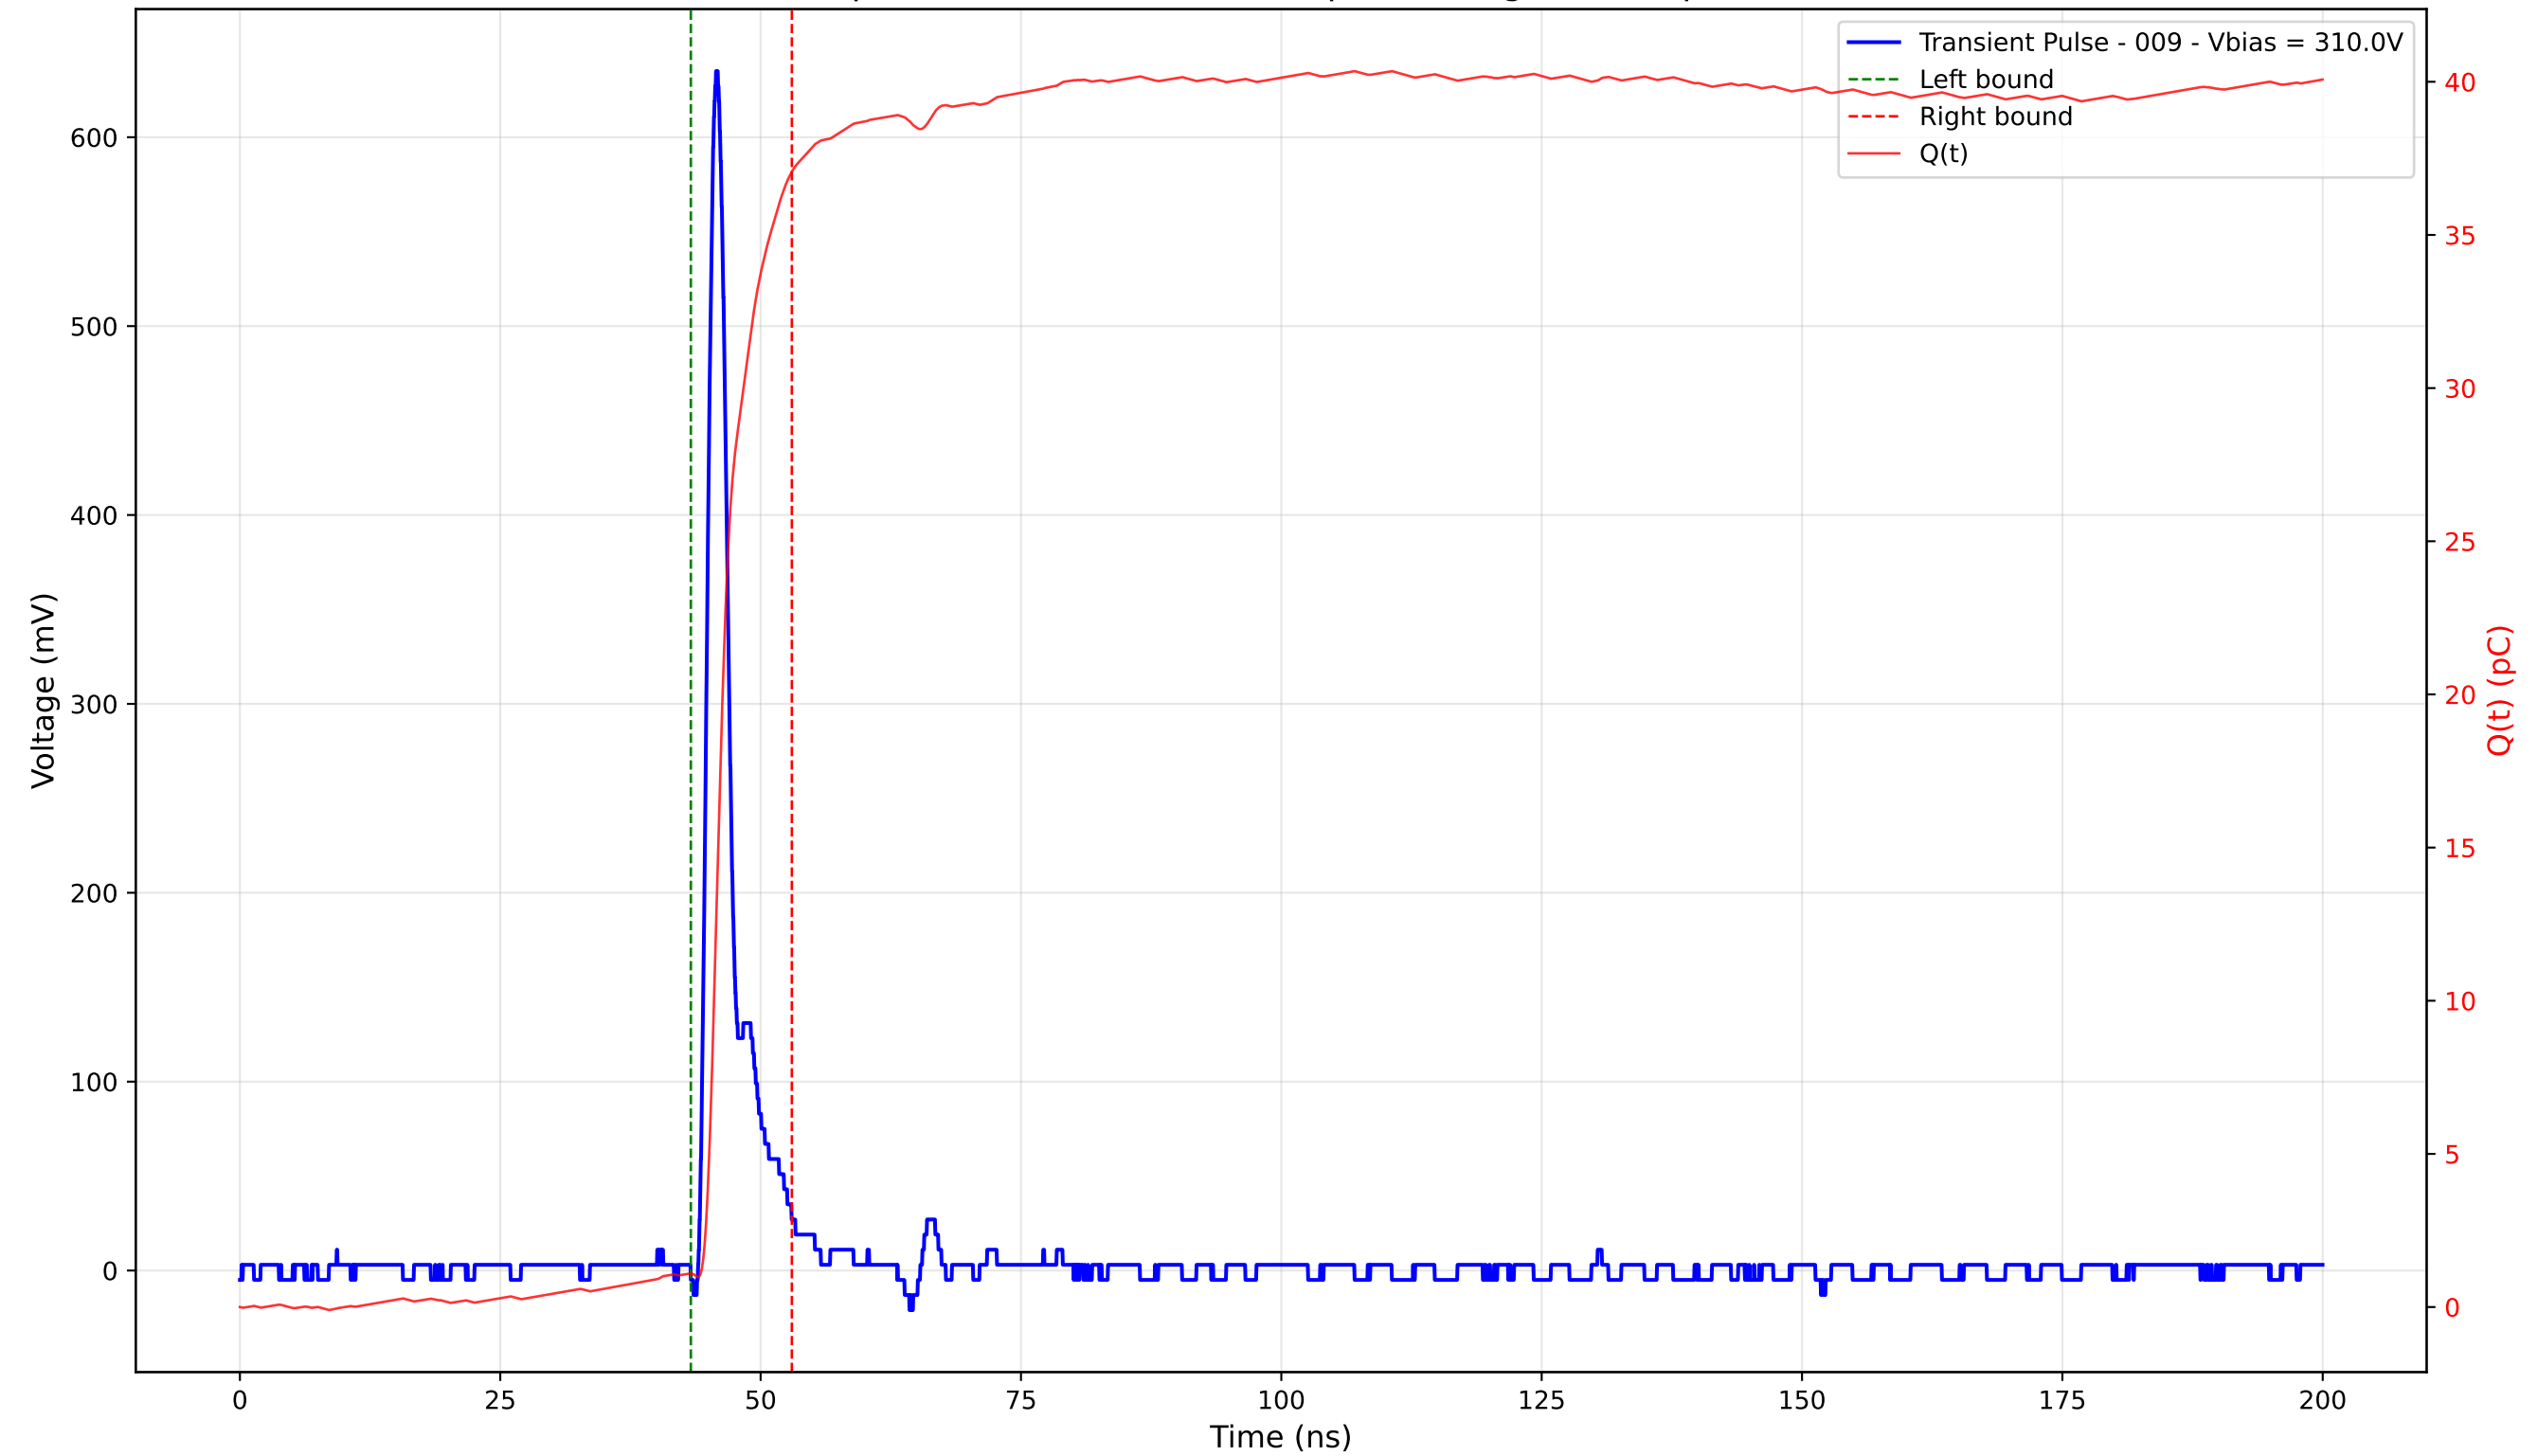


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 35.01 pC - Rise Time: 1.07 ns

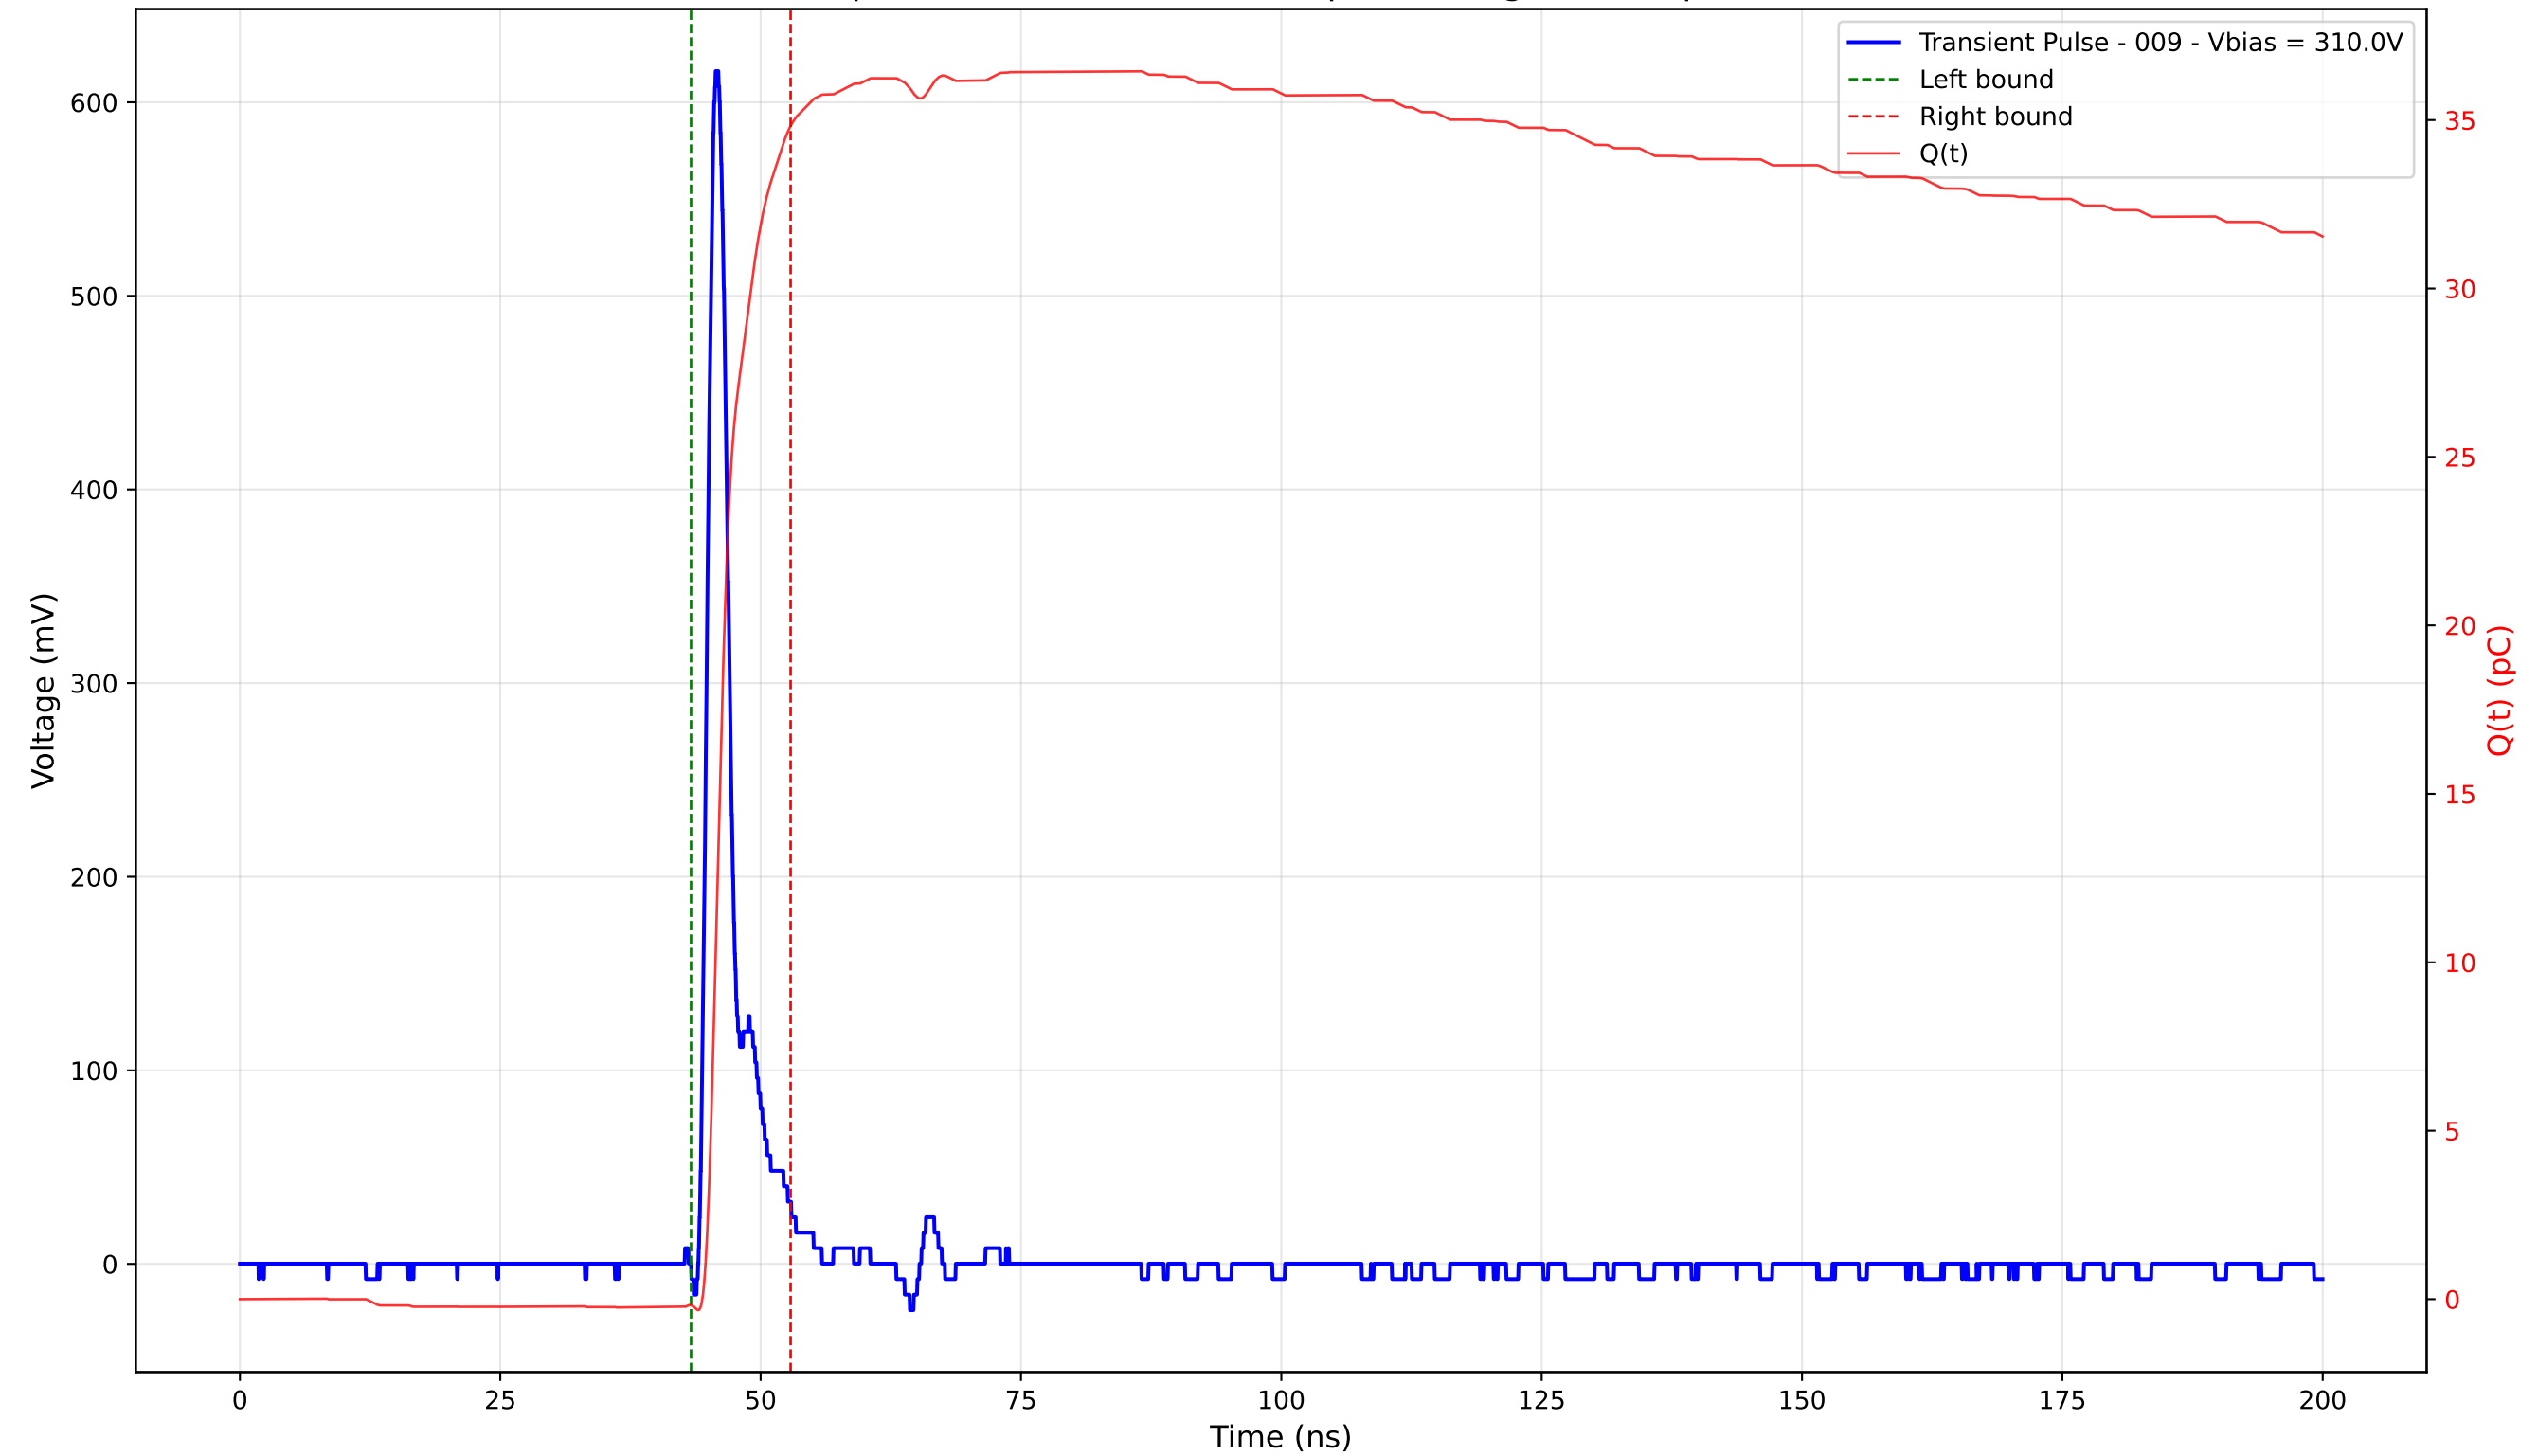


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 35.49 pC - Rise Time: 1.10 ns

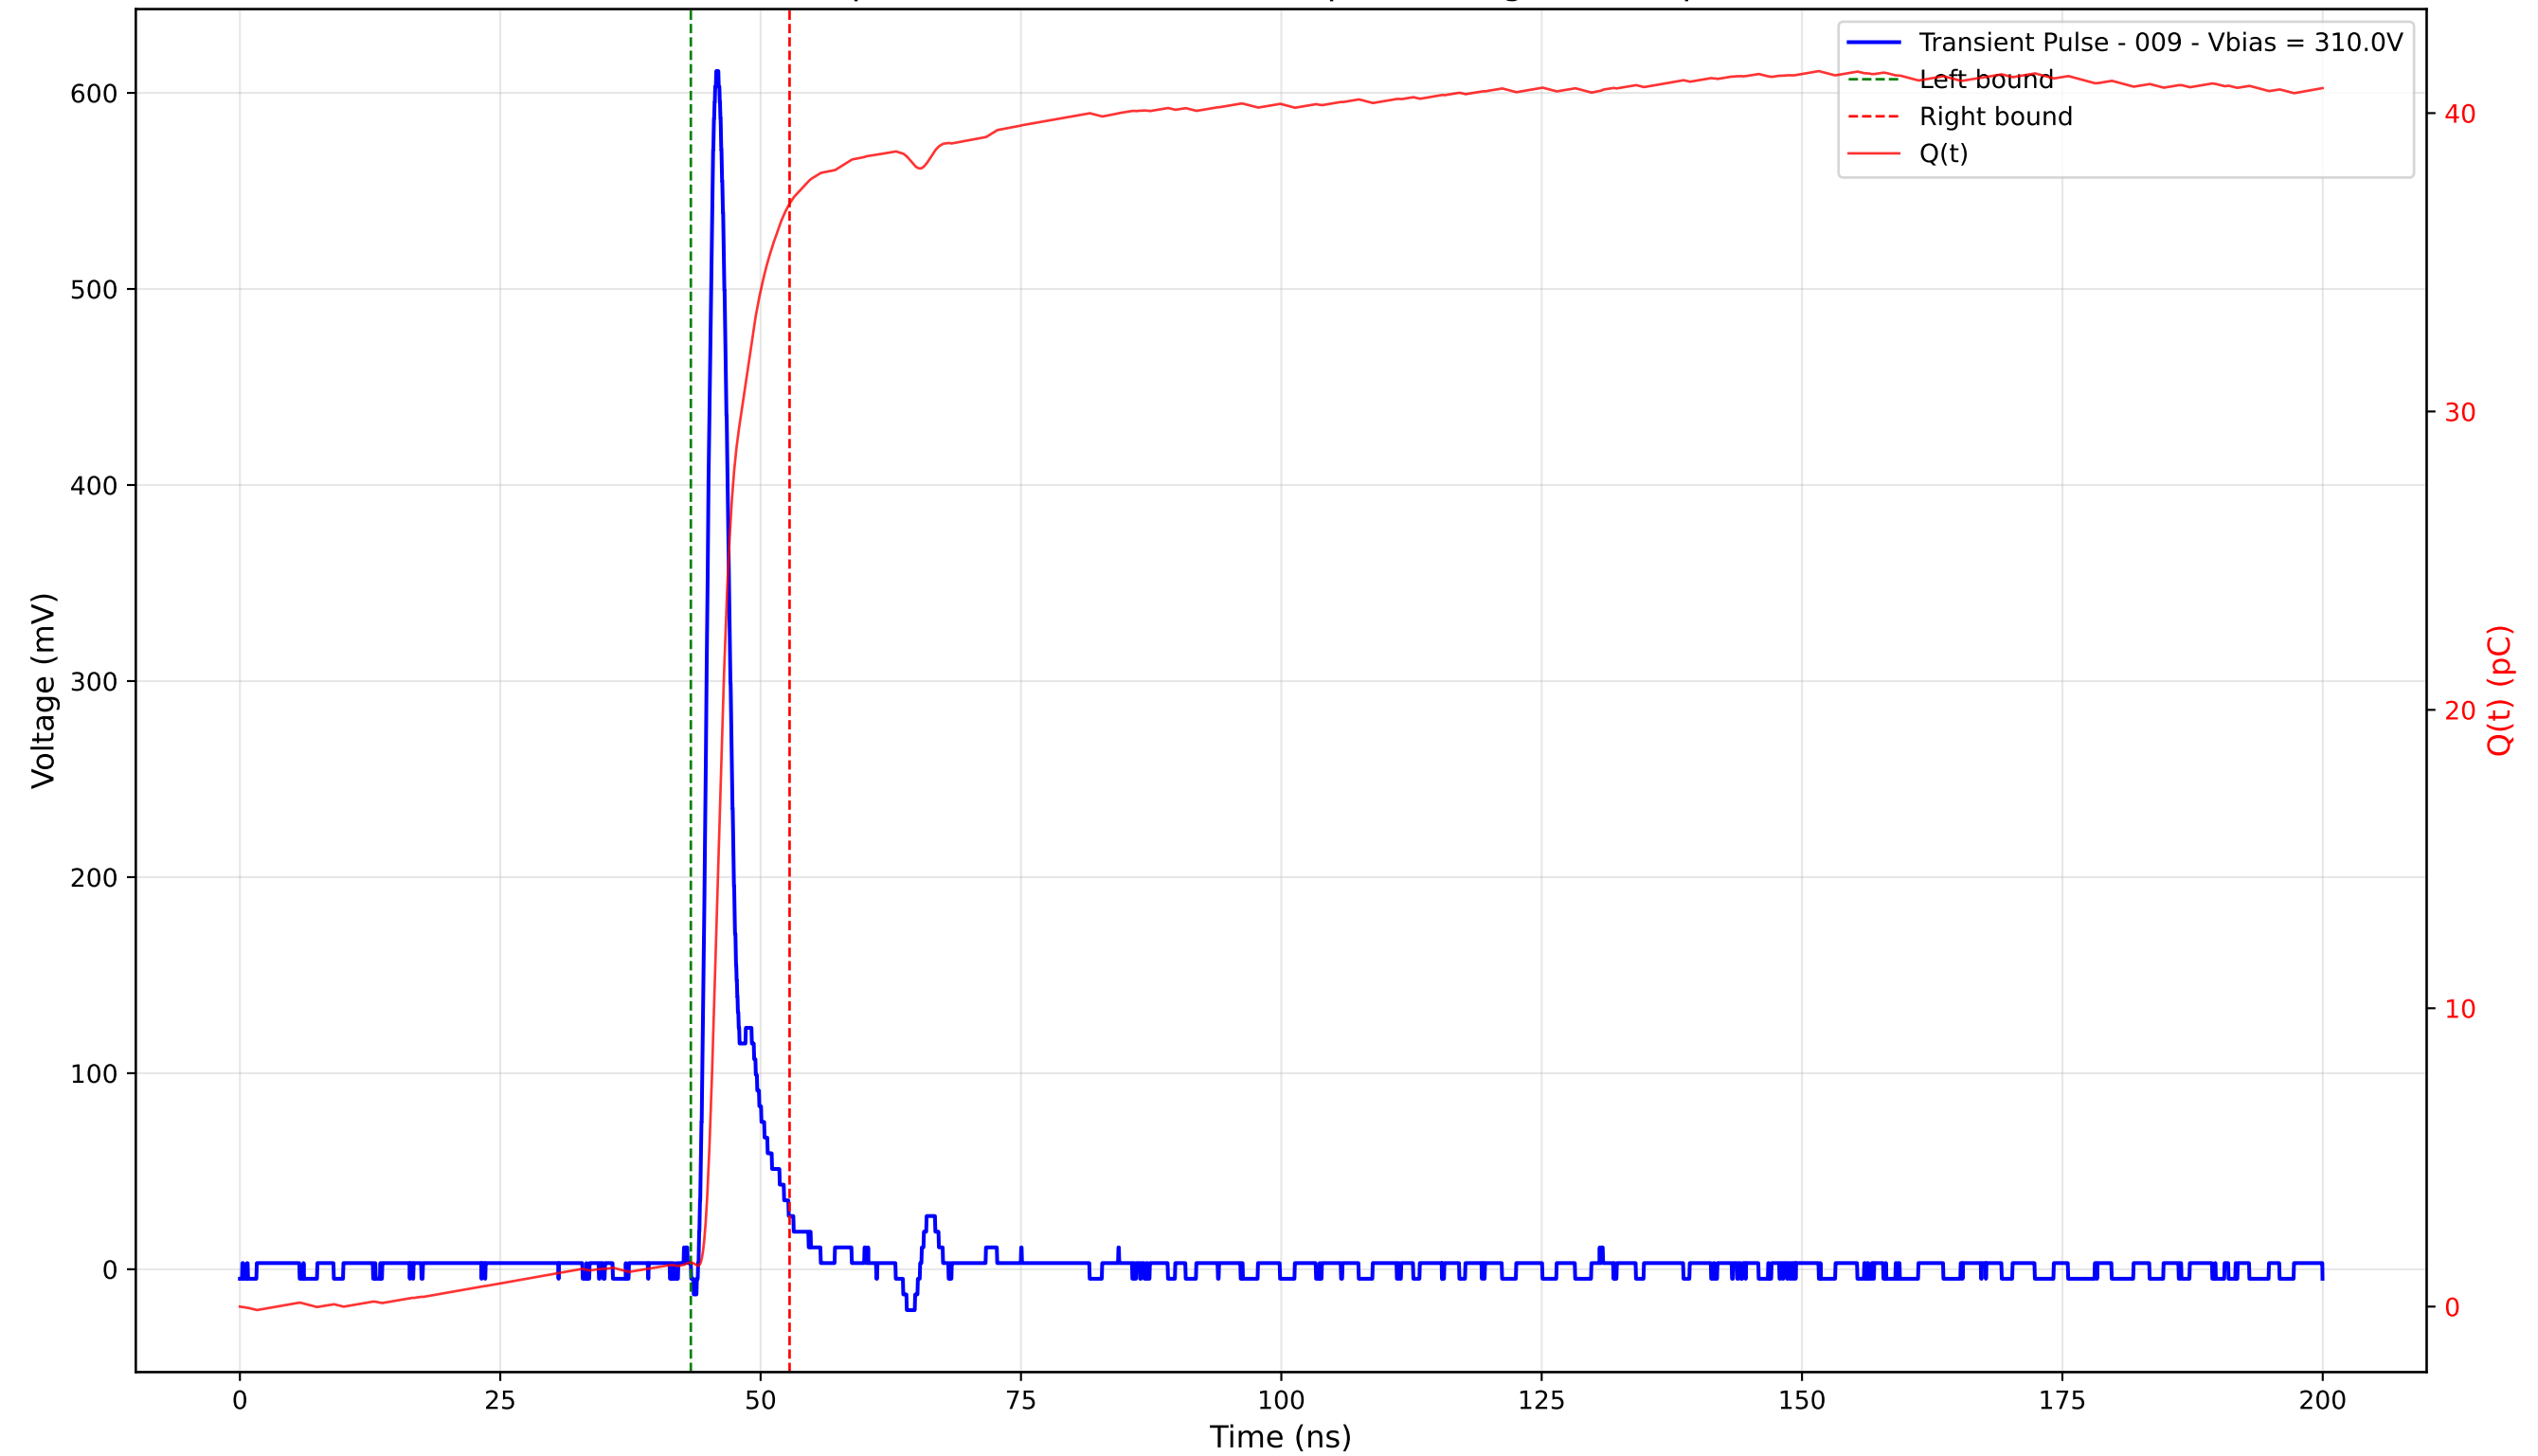


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 34.65 pC - Rise Time: 1.07 ns

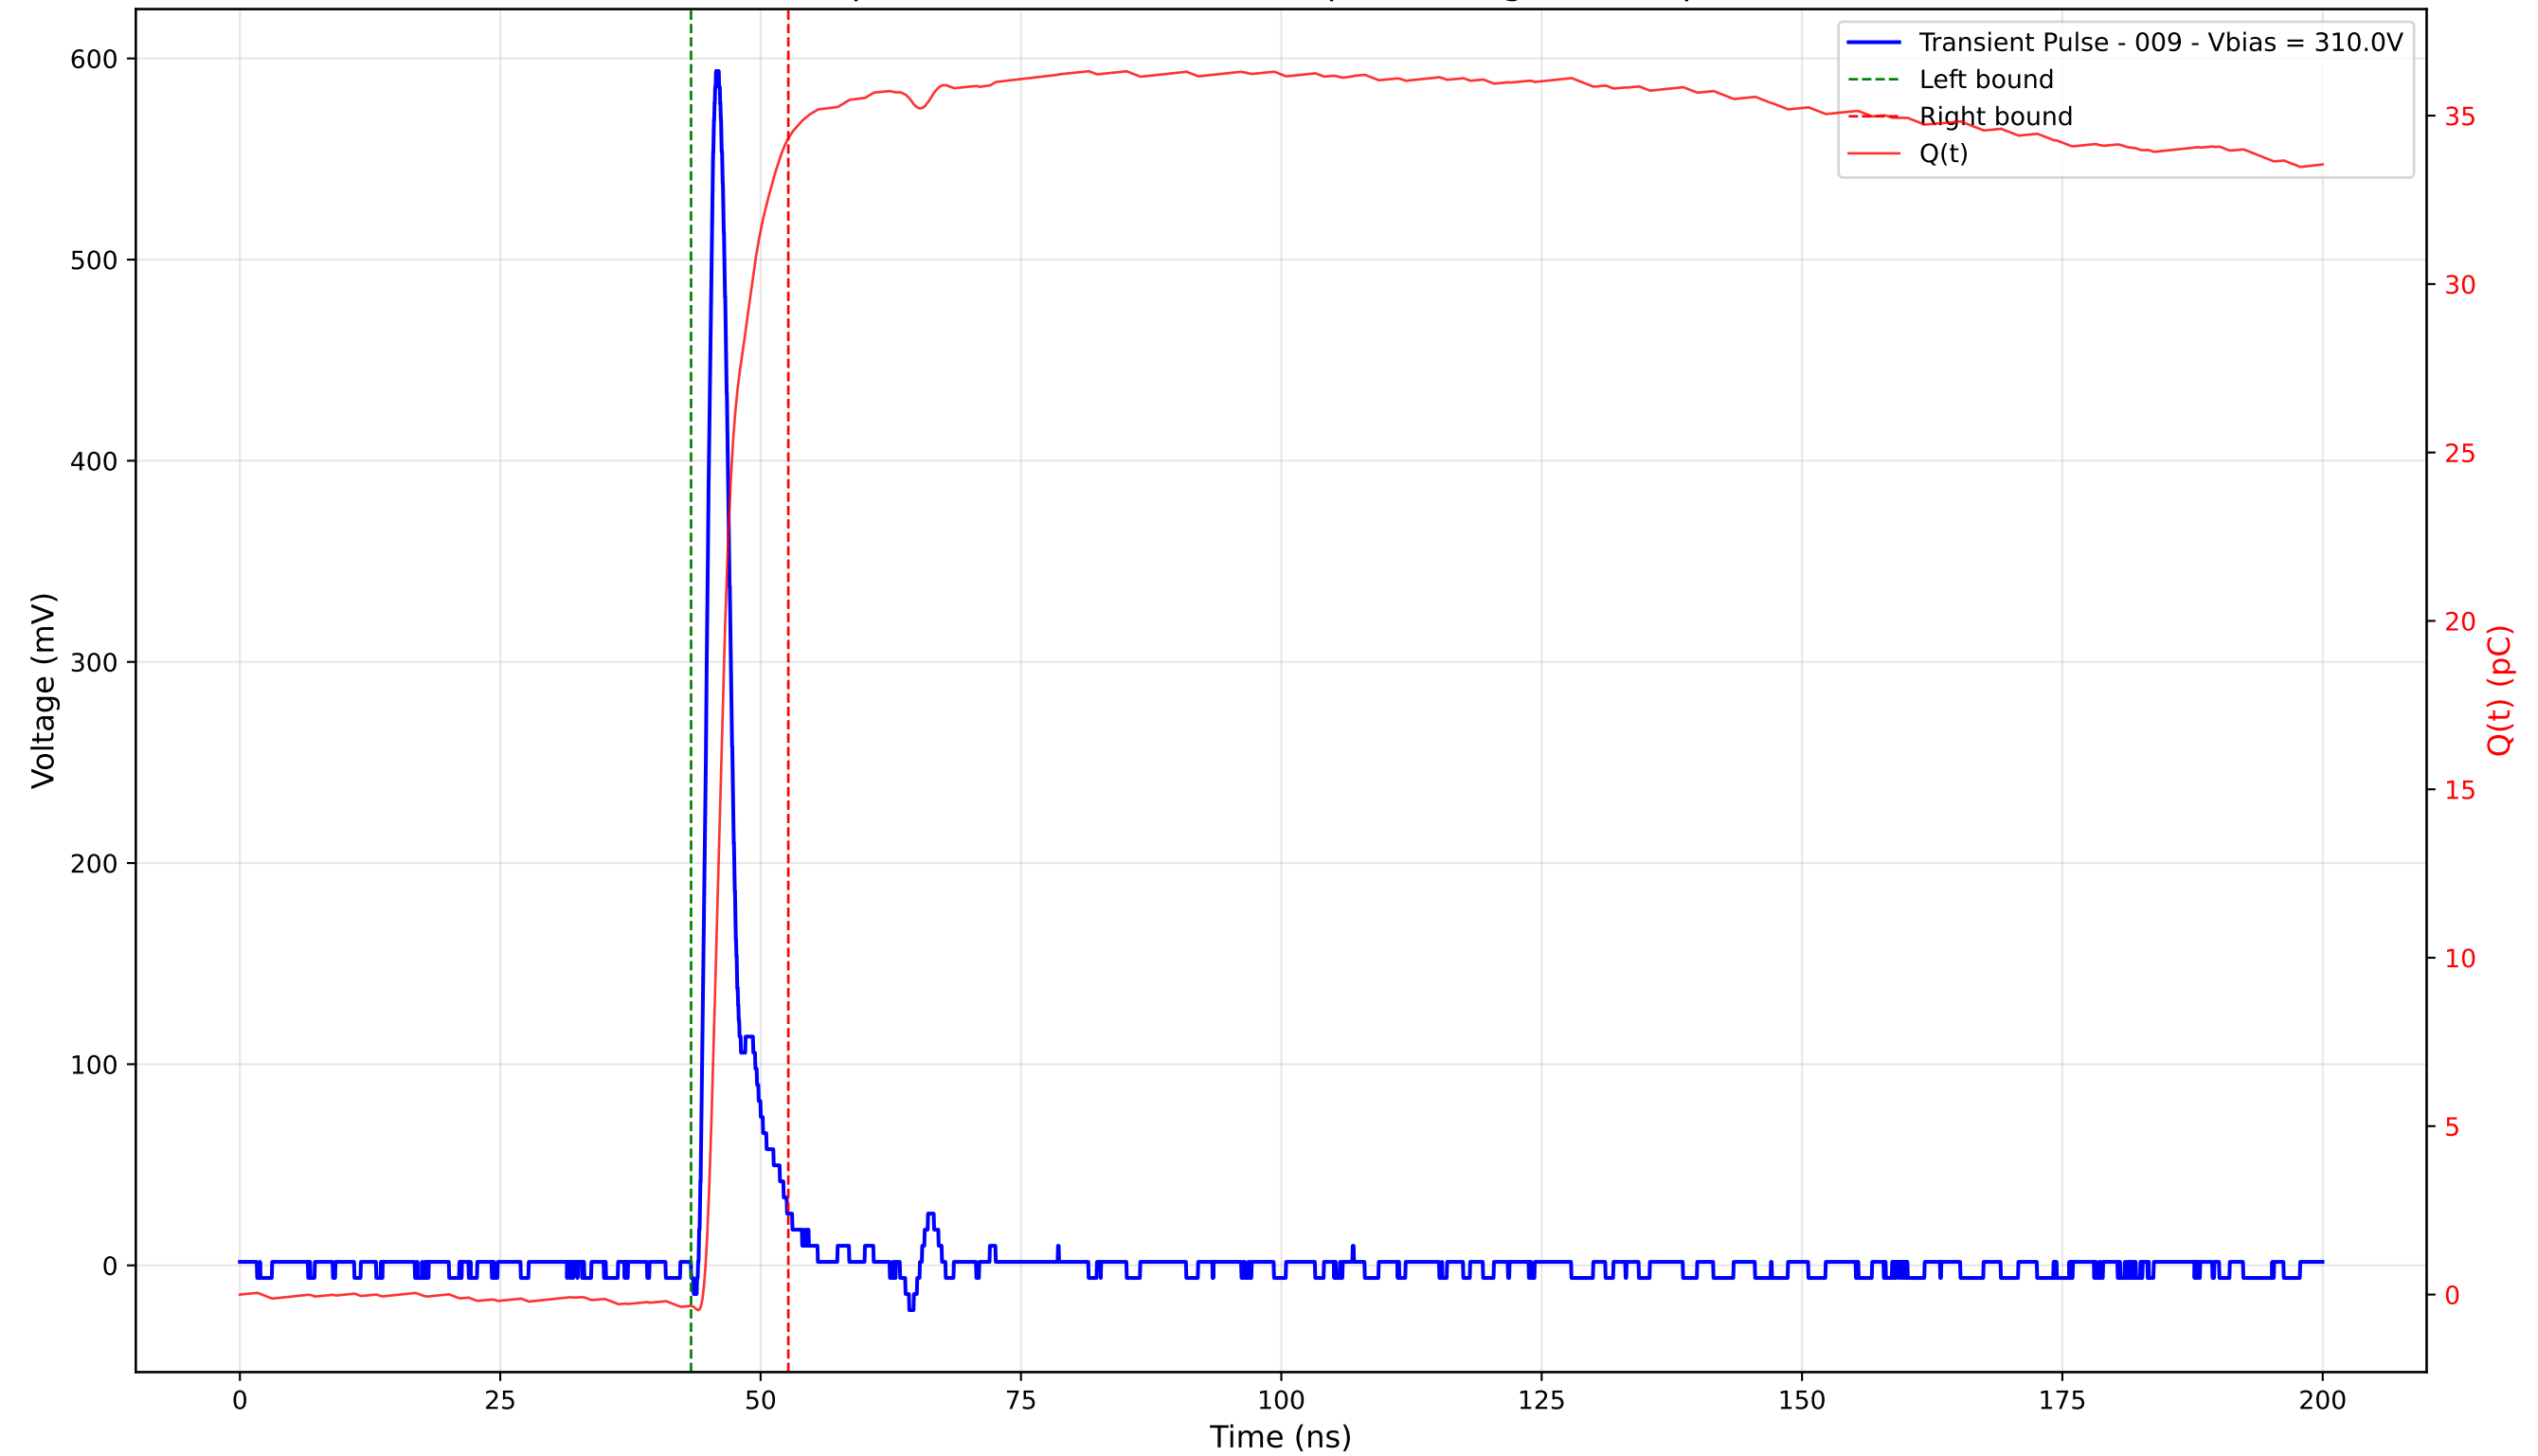


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 35.08 pC - Rise Time: 1.07 ns

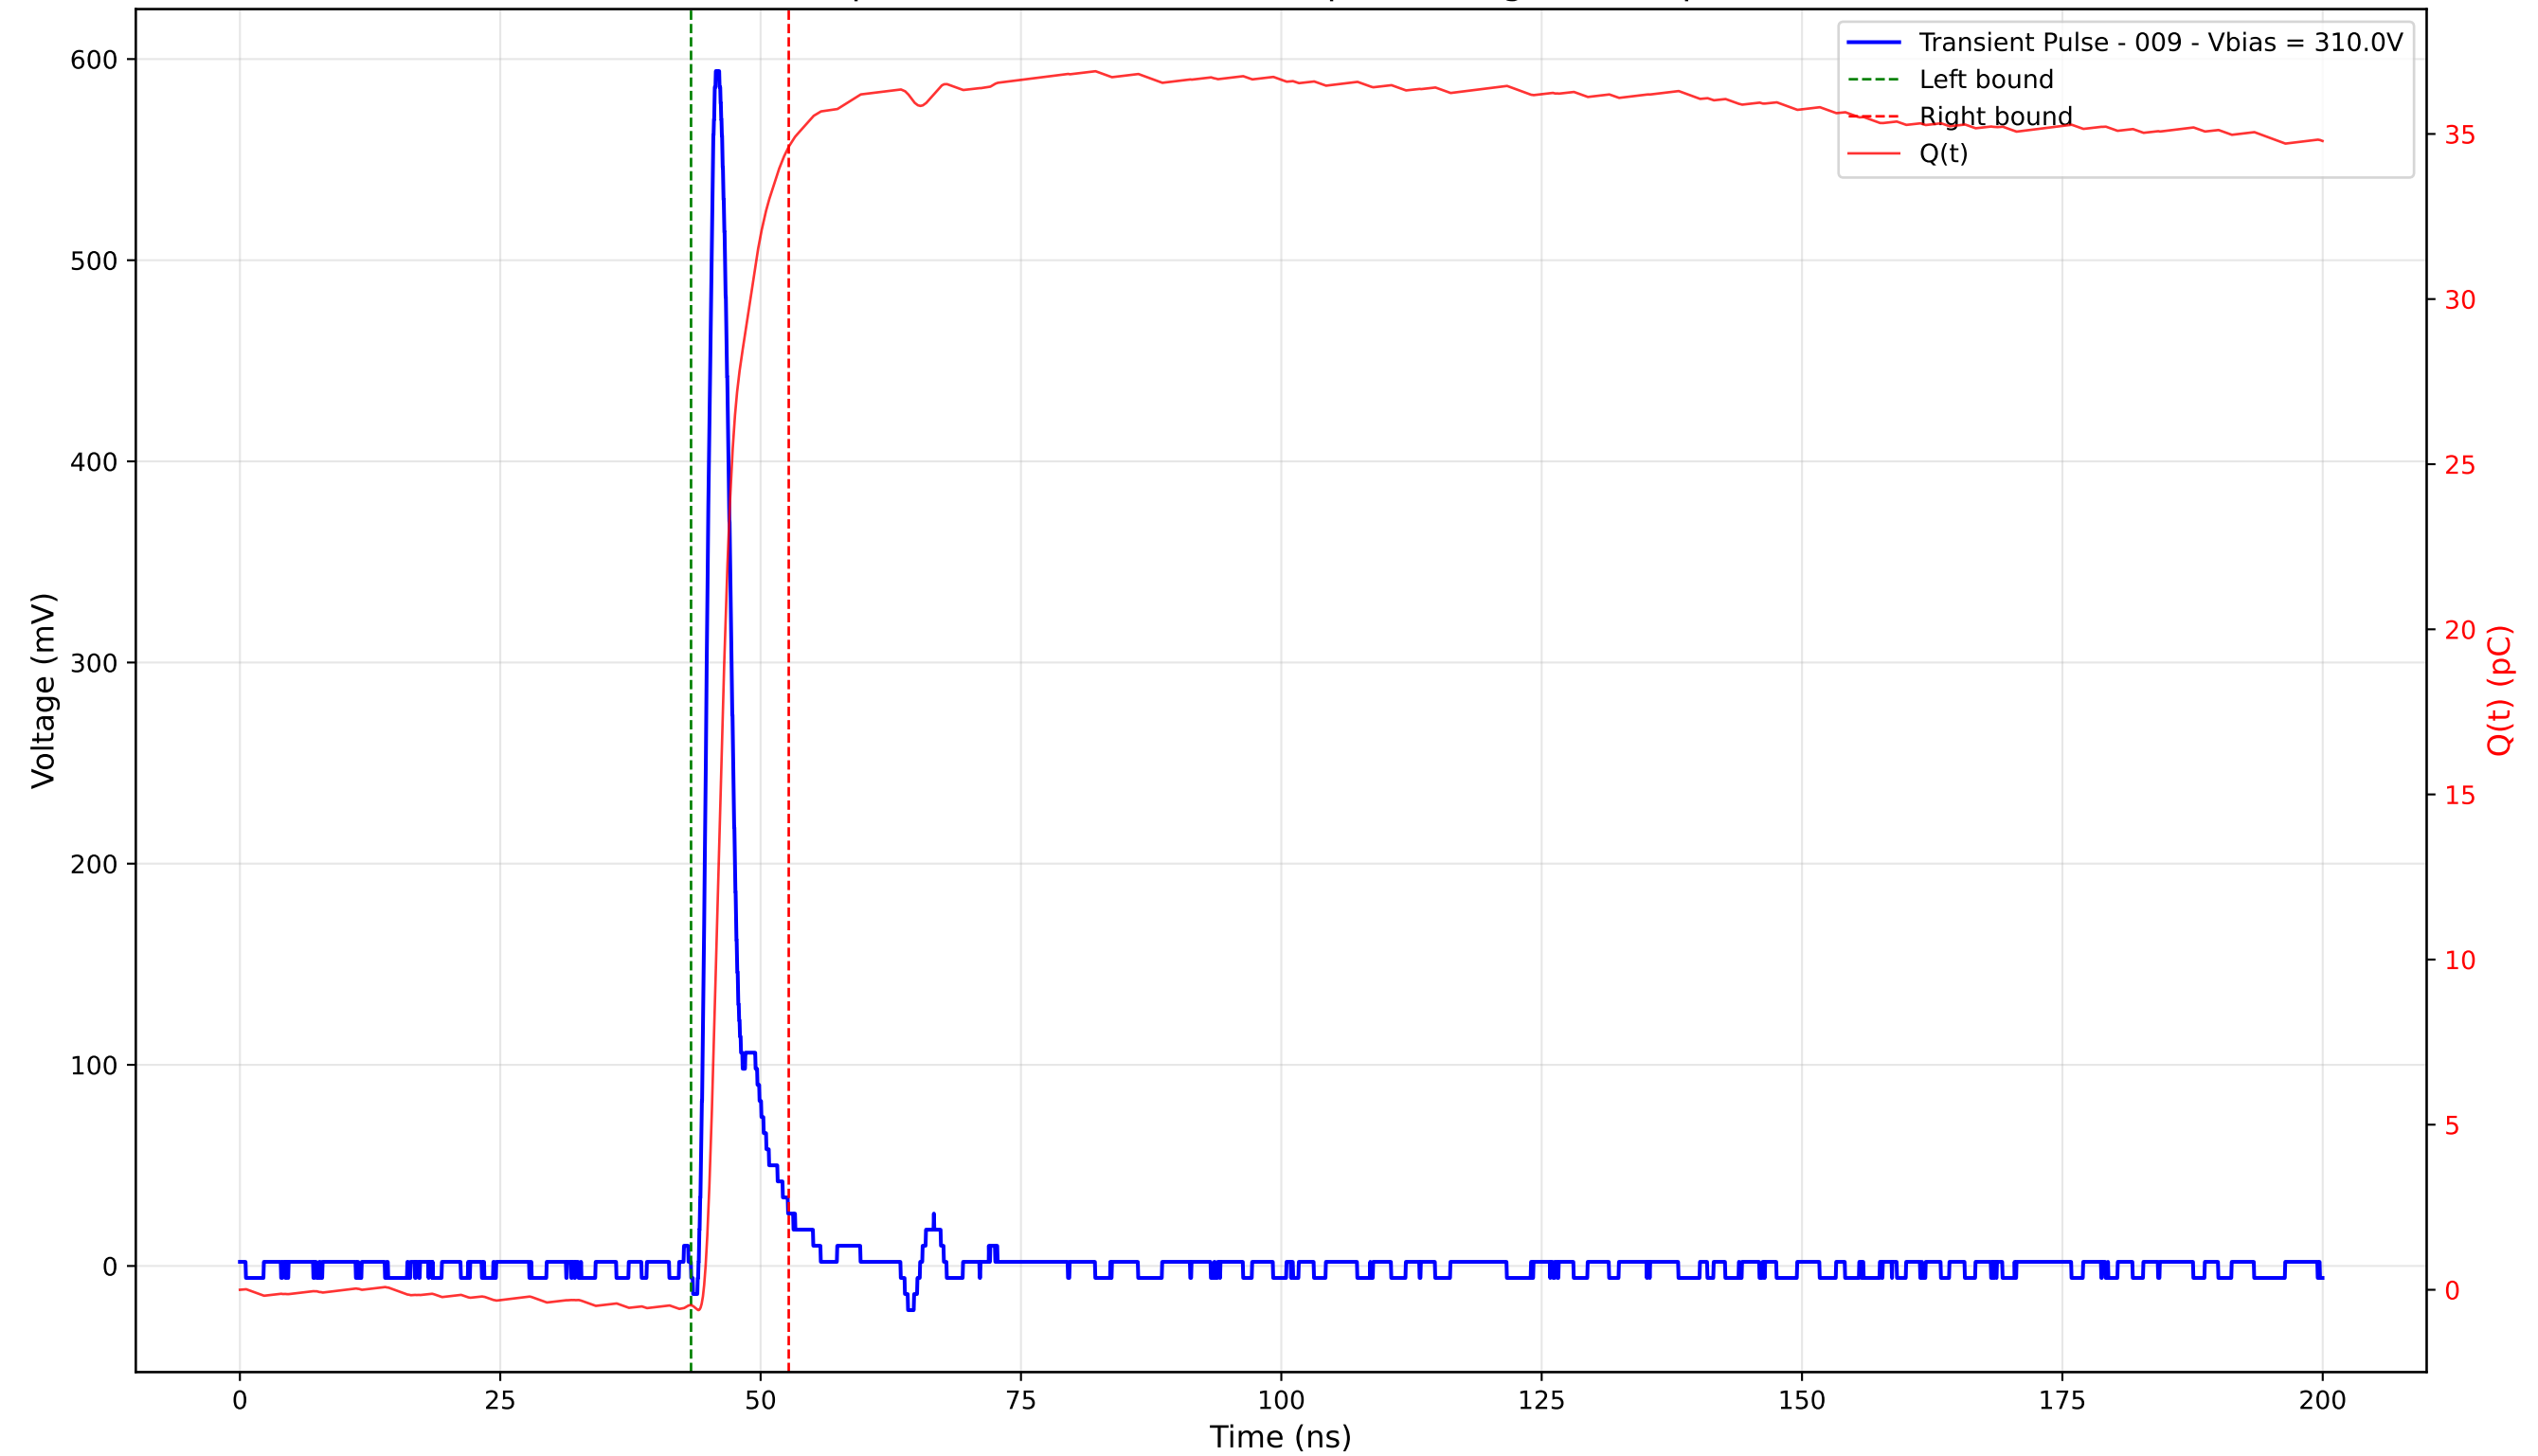


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 34.56 pC - Rise Time: 1.09 ns

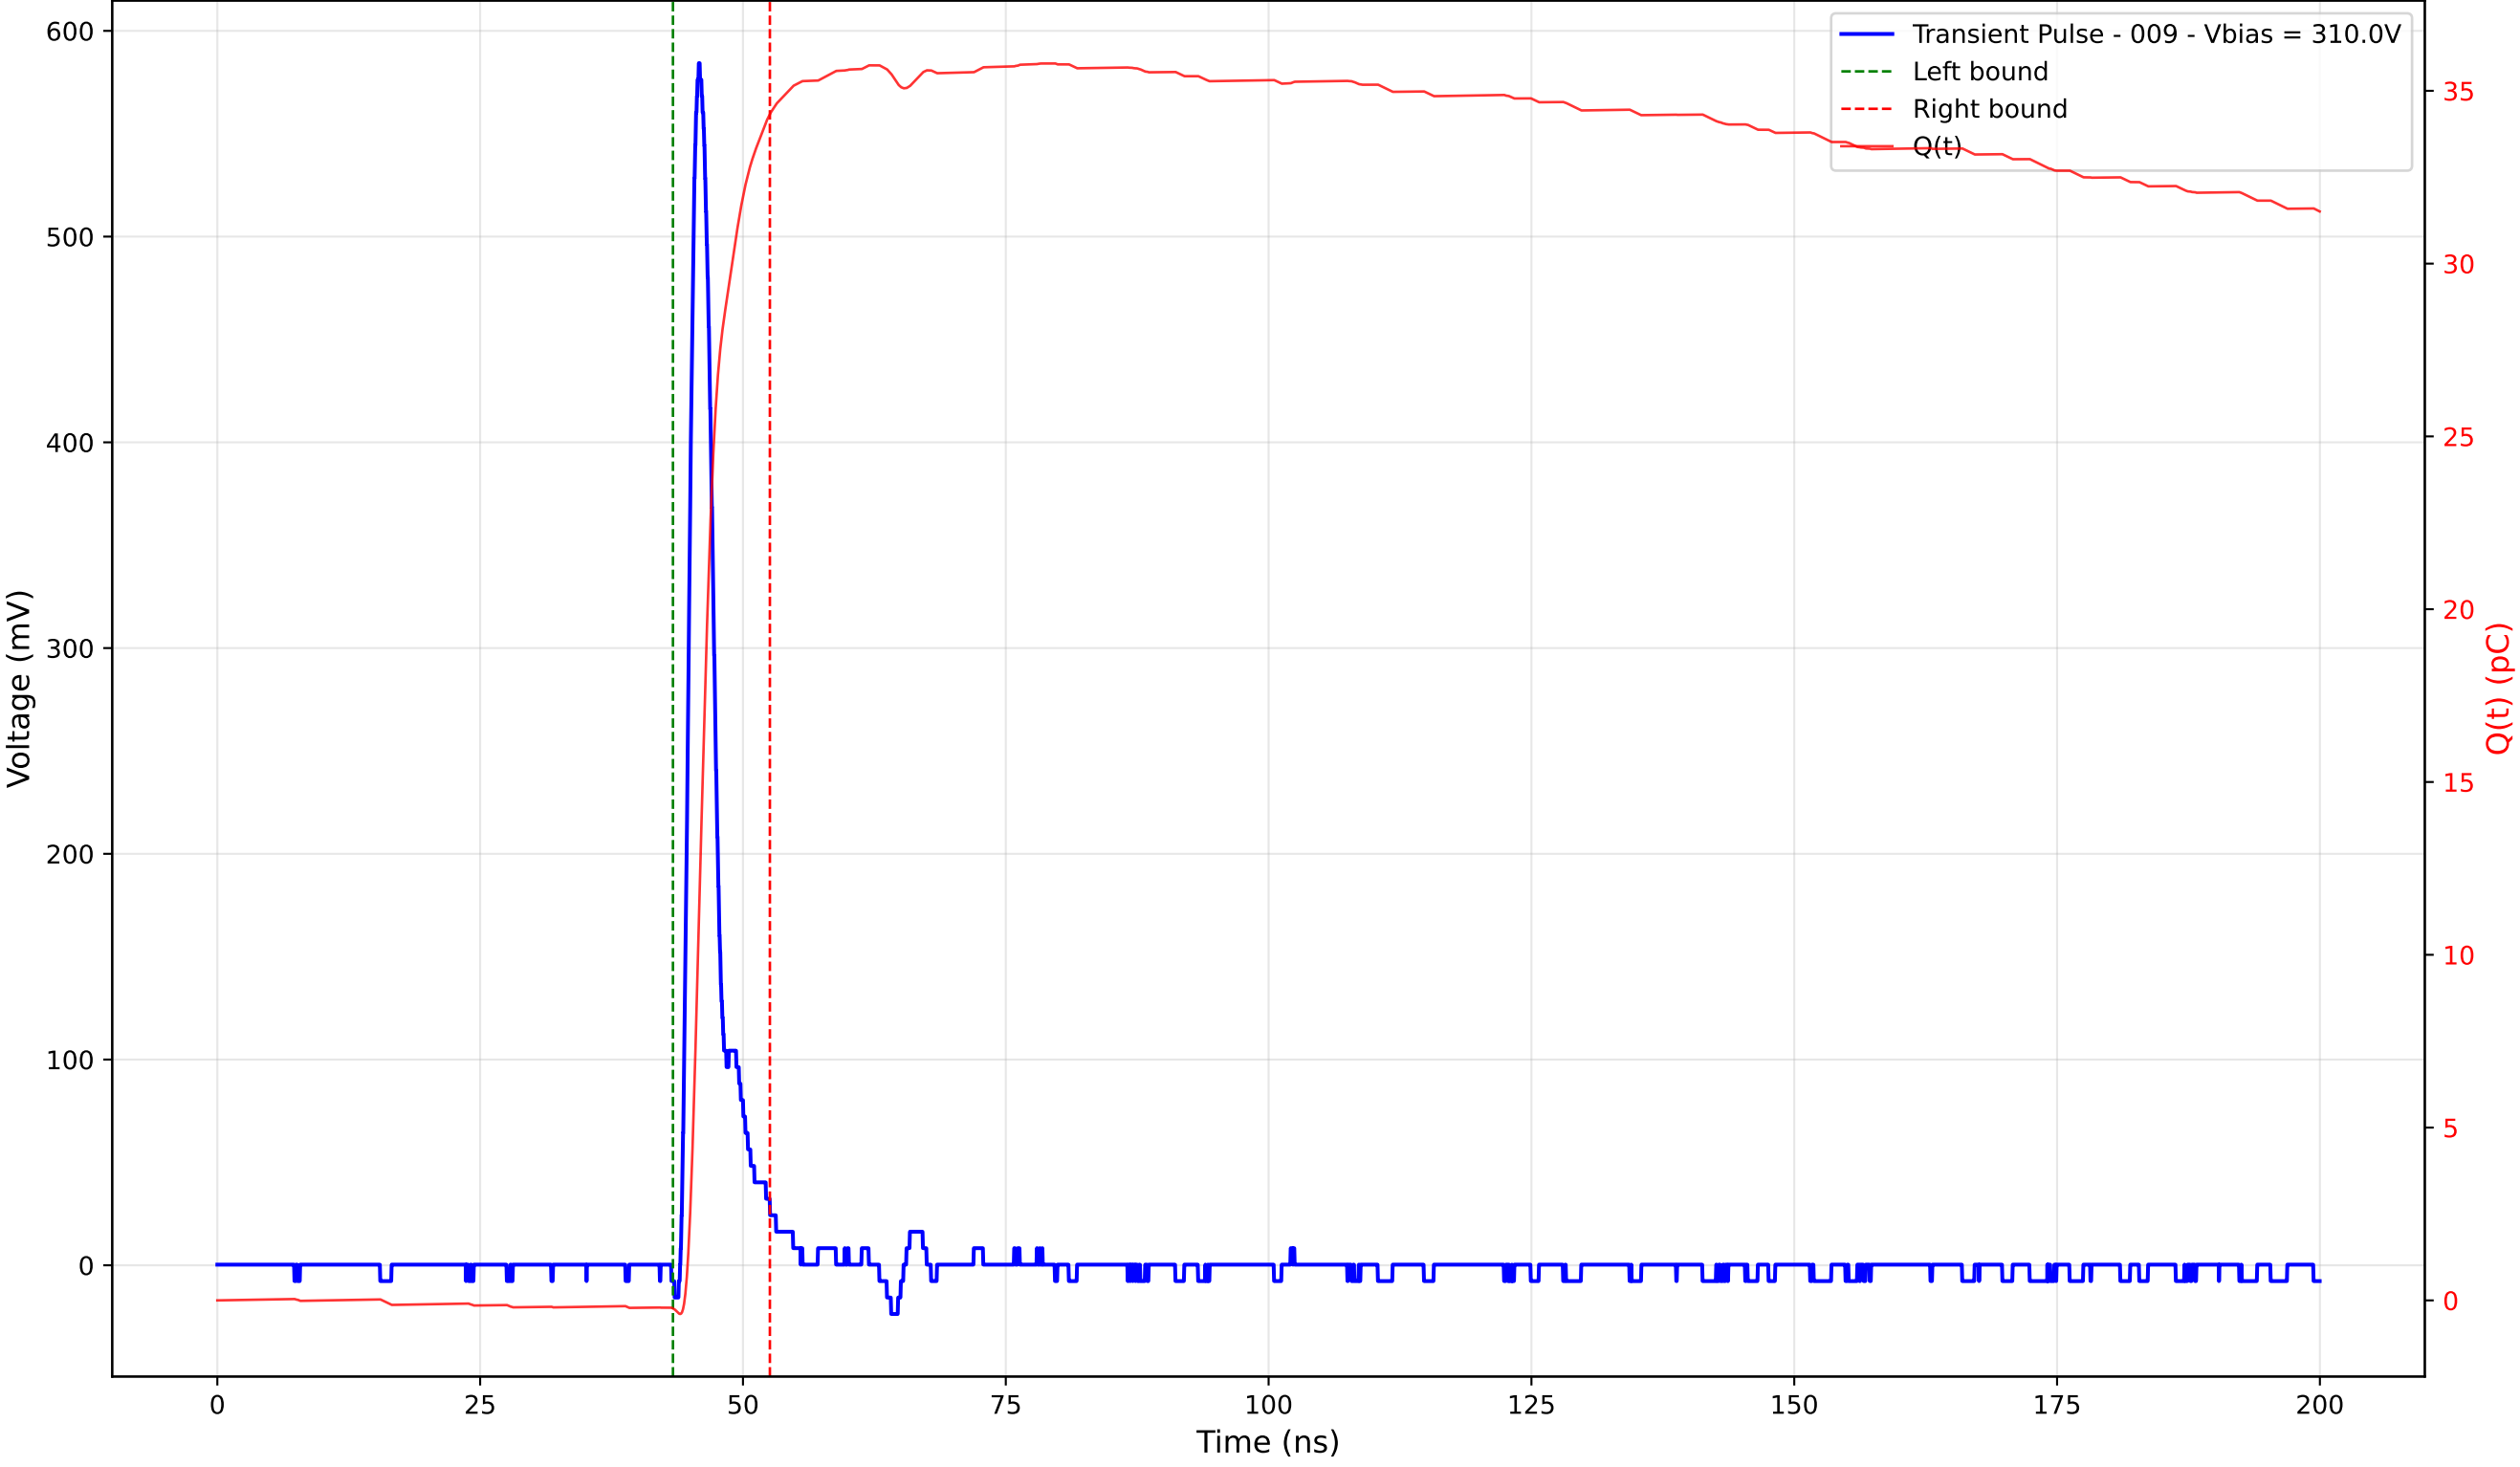


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 34.87 pC - Rise Time: 1.10 ns

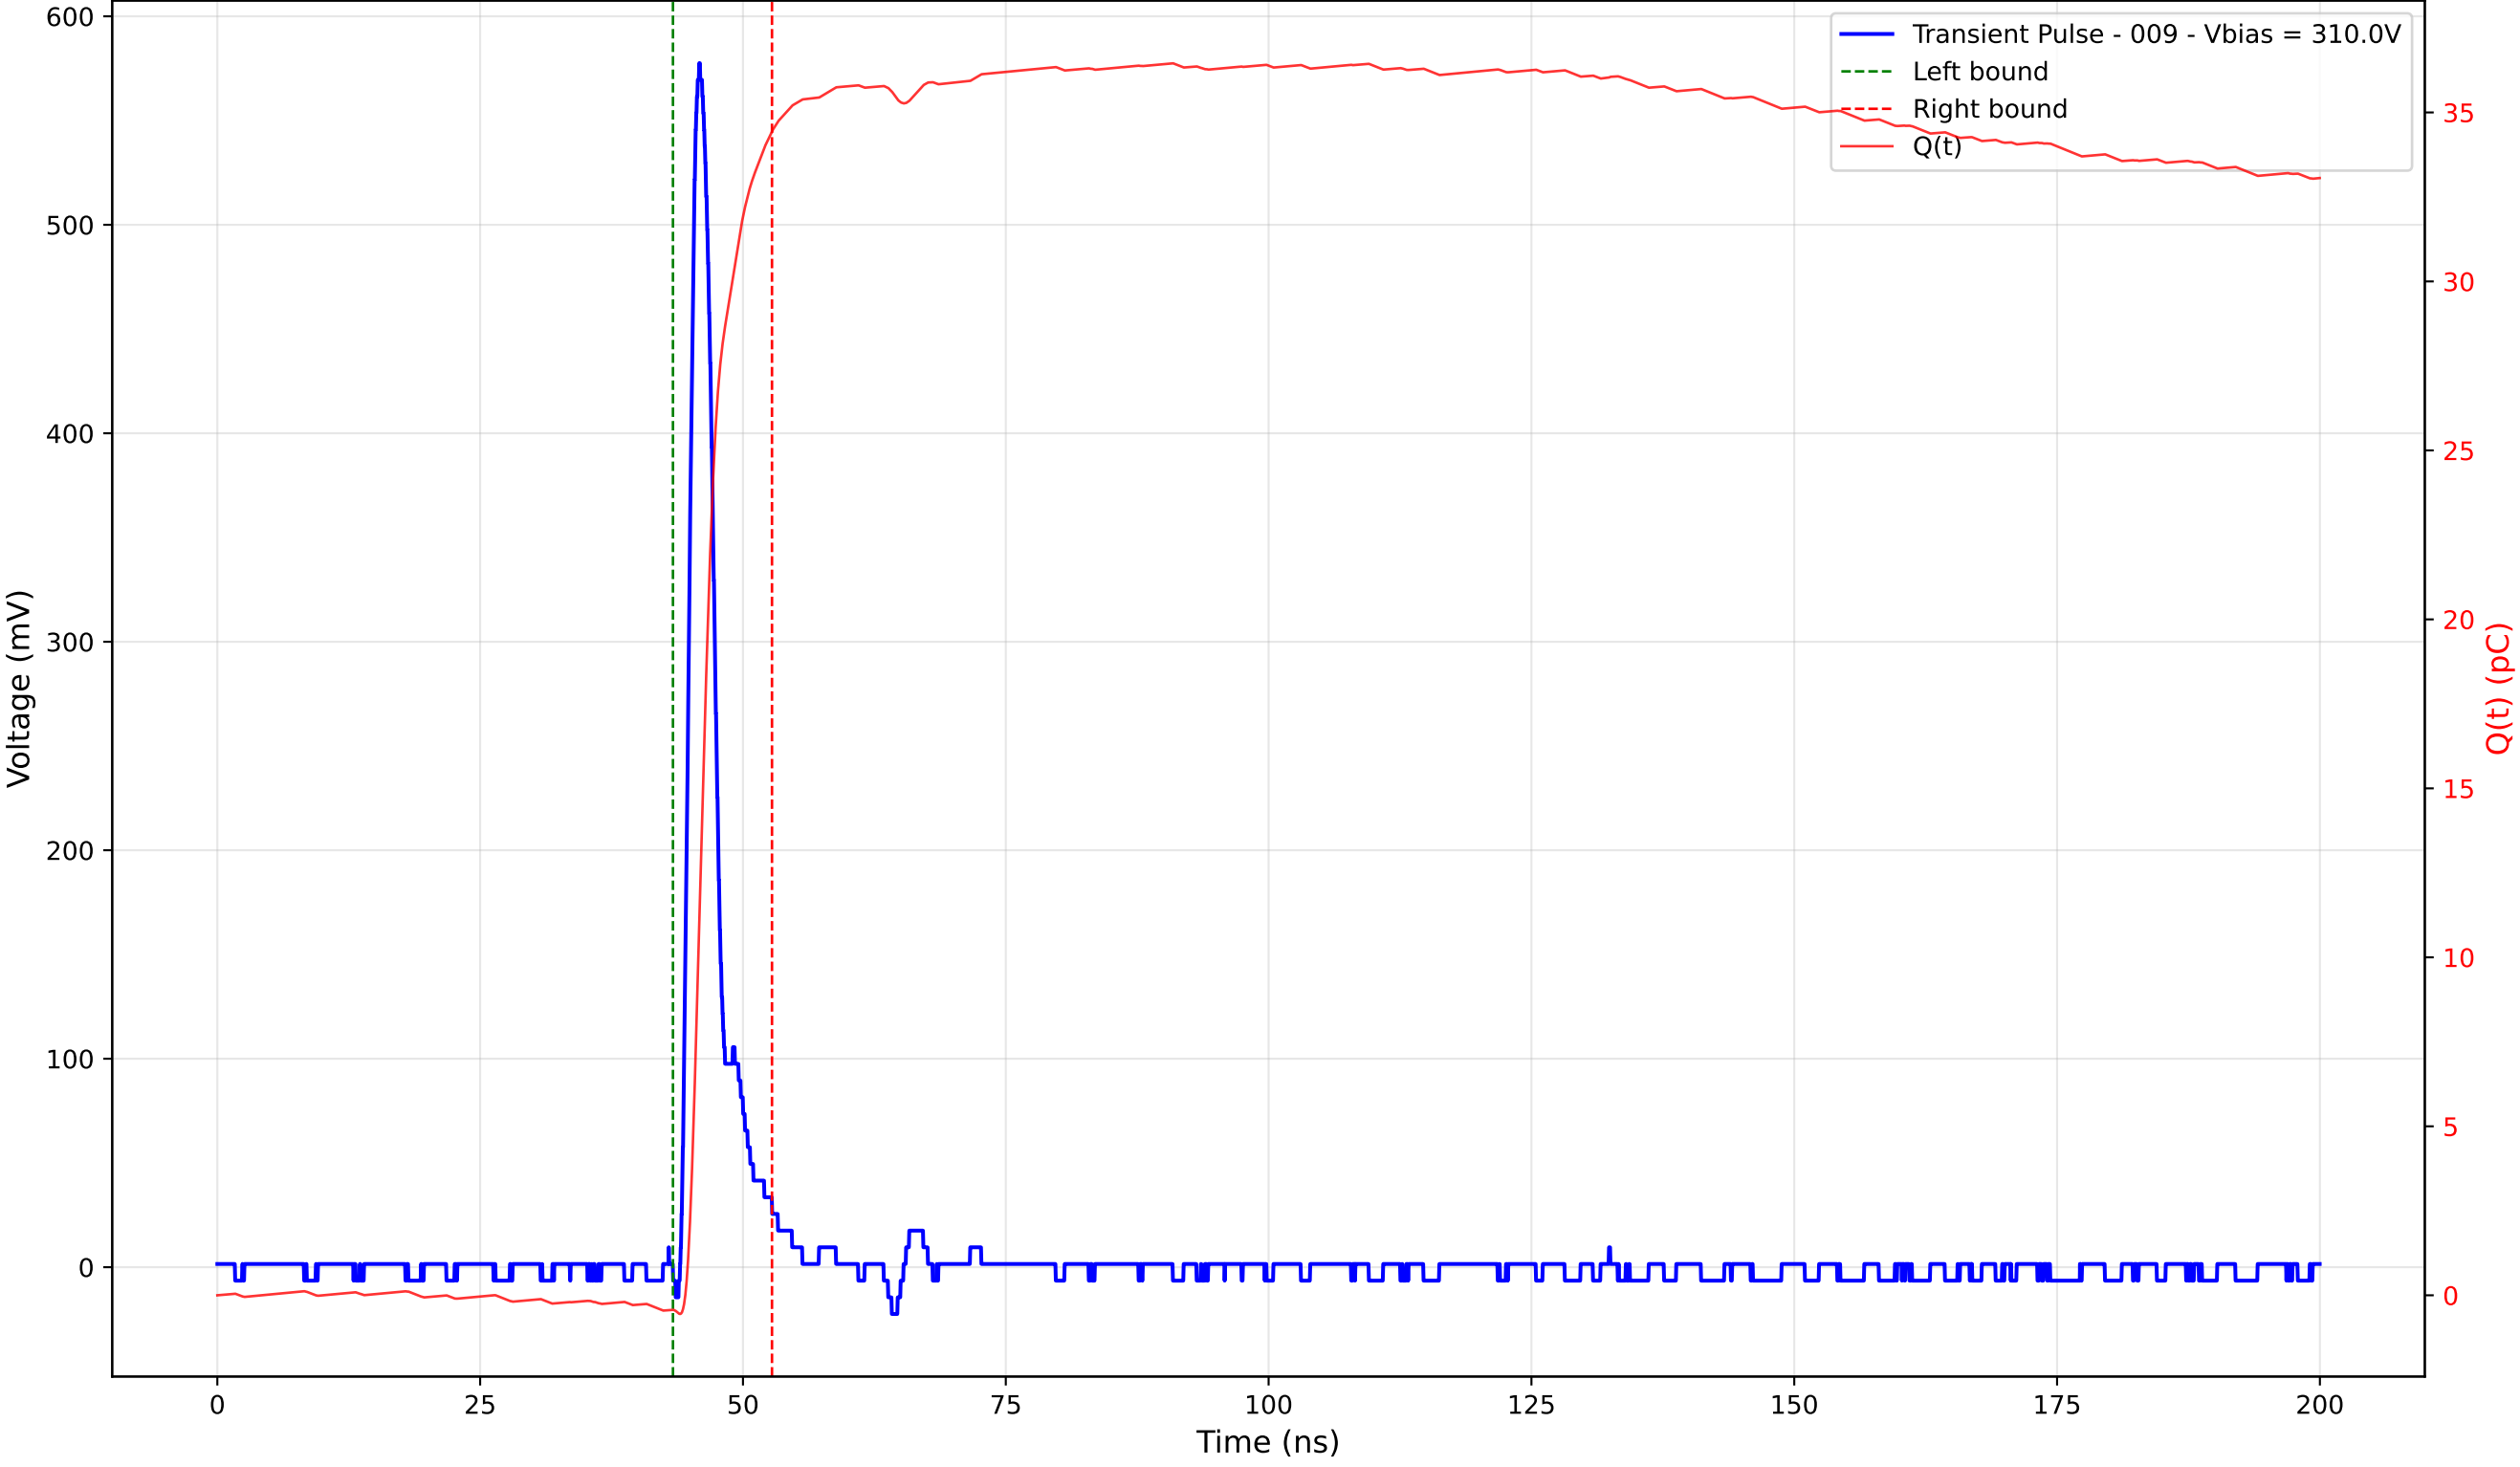


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 34.02 pC - Rise Time: 1.10 ns

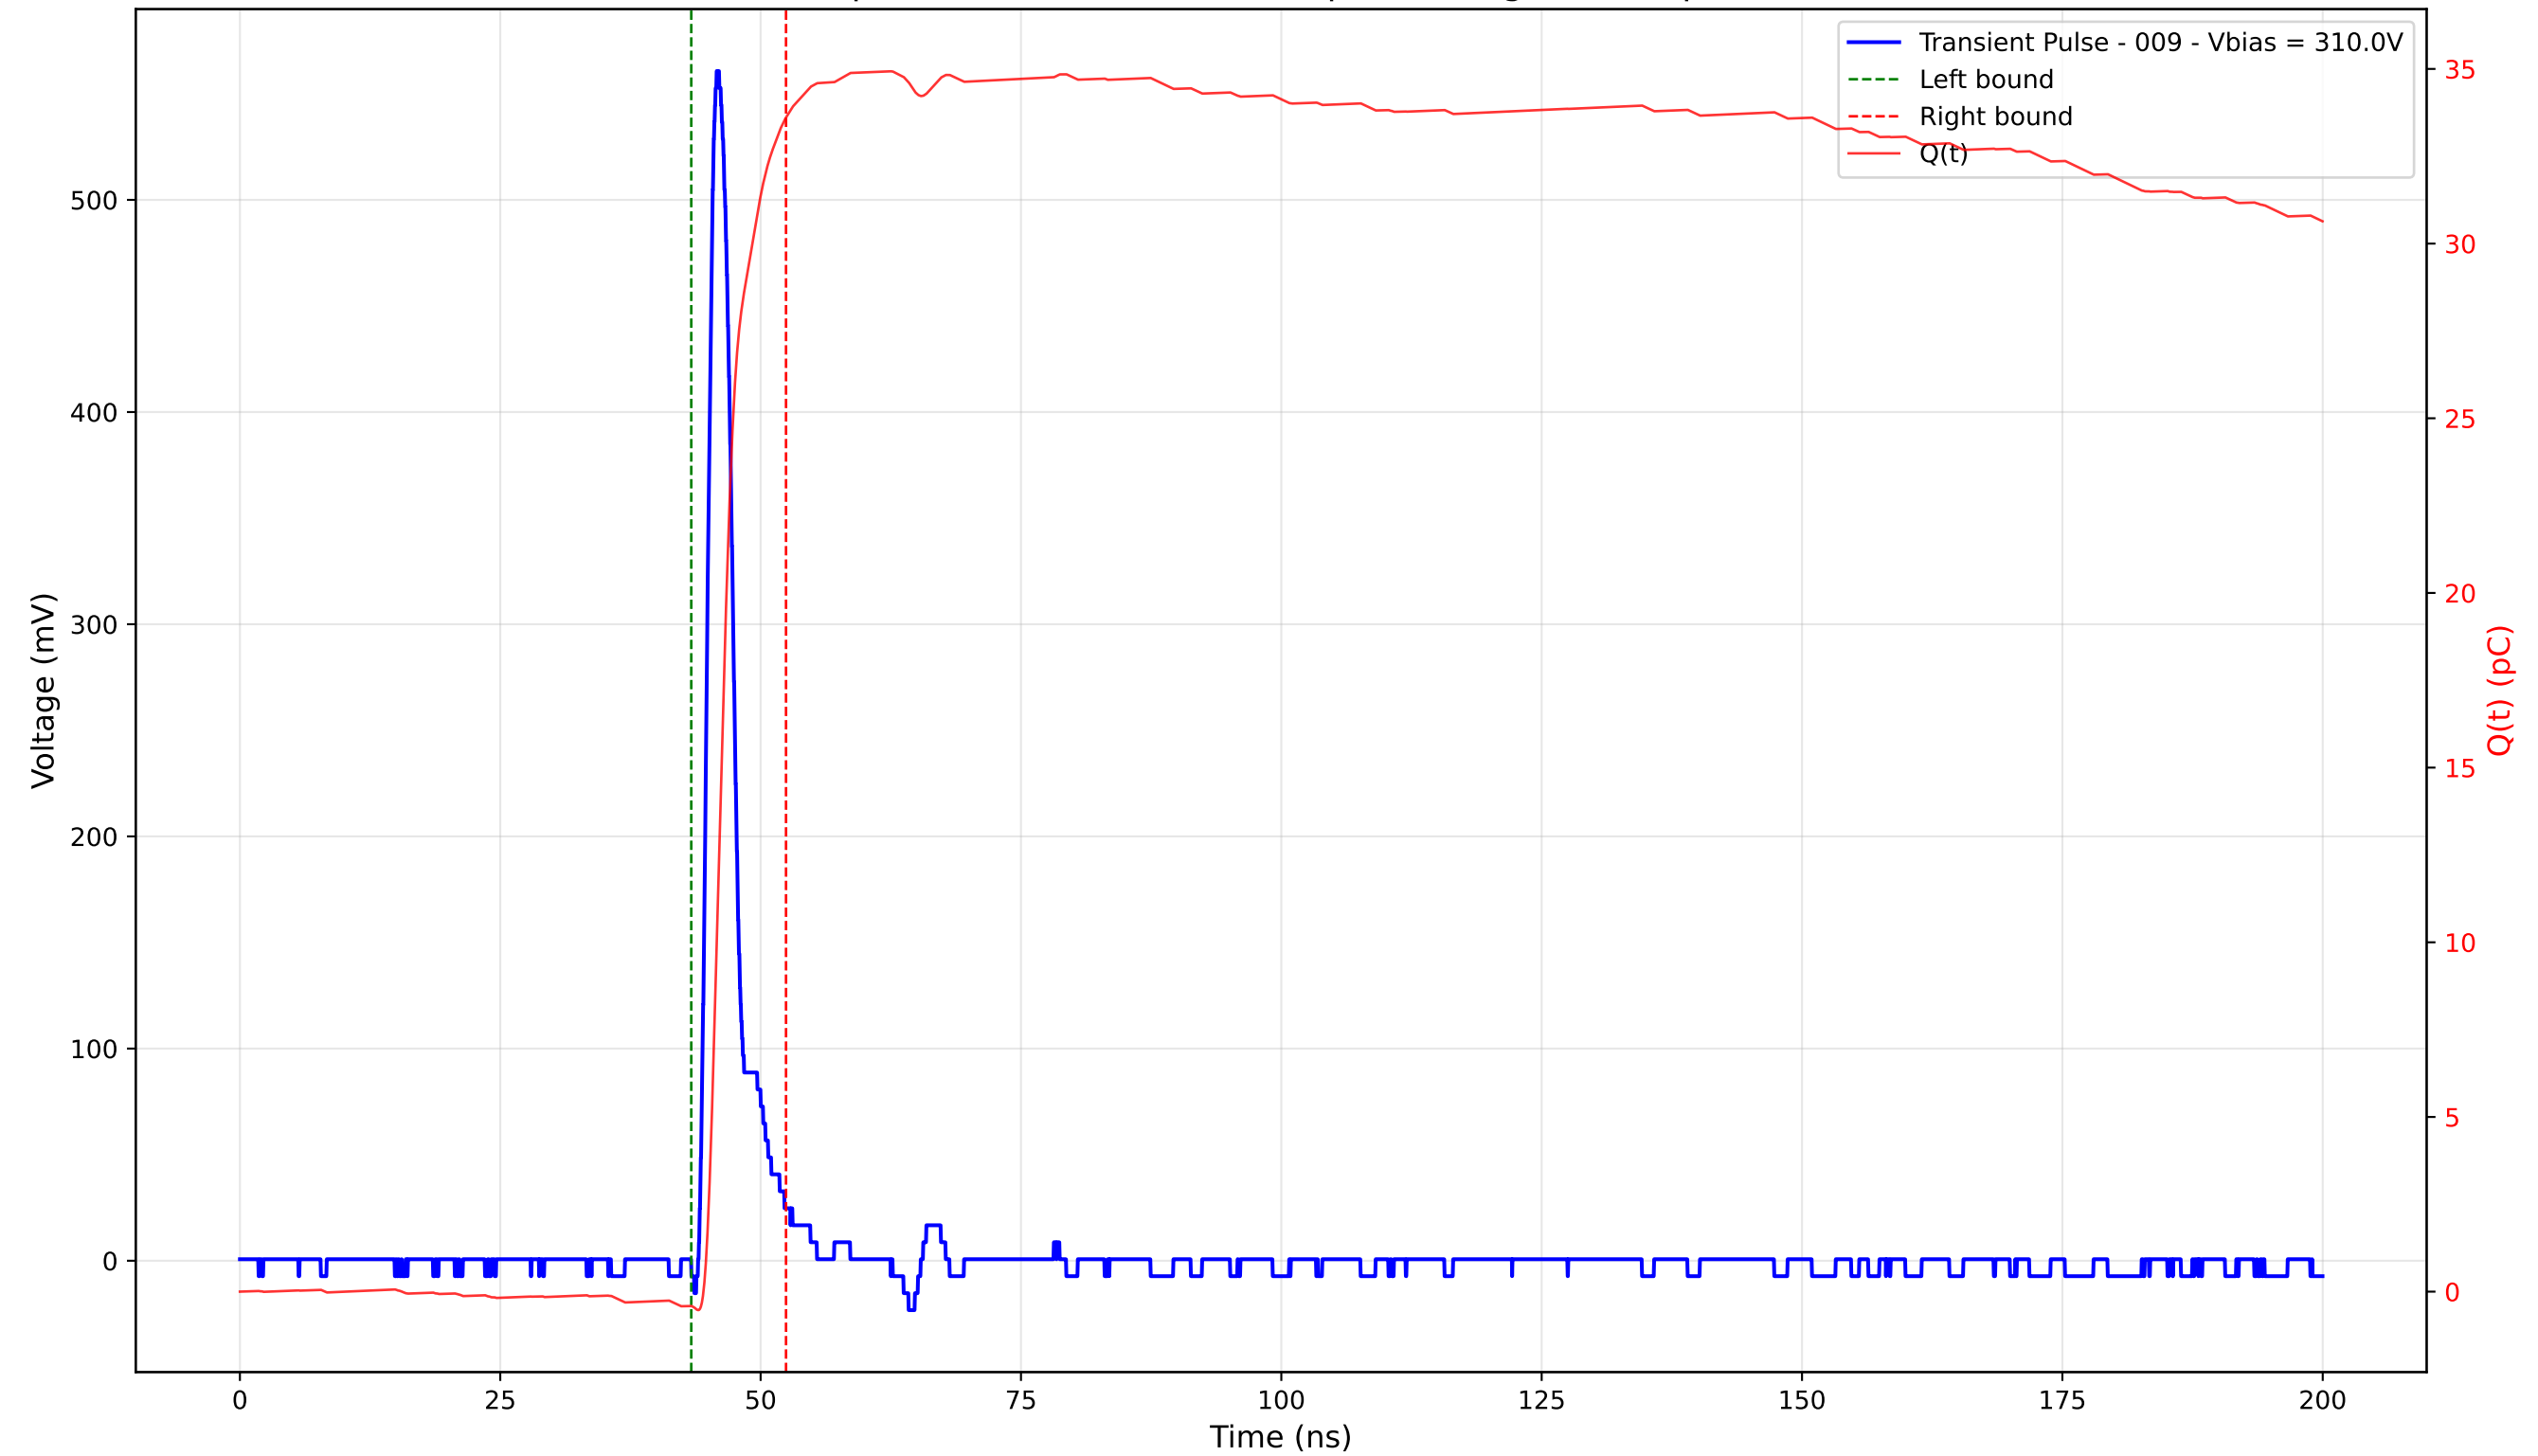


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 34.48 pC - Rise Time: 1.11 ns

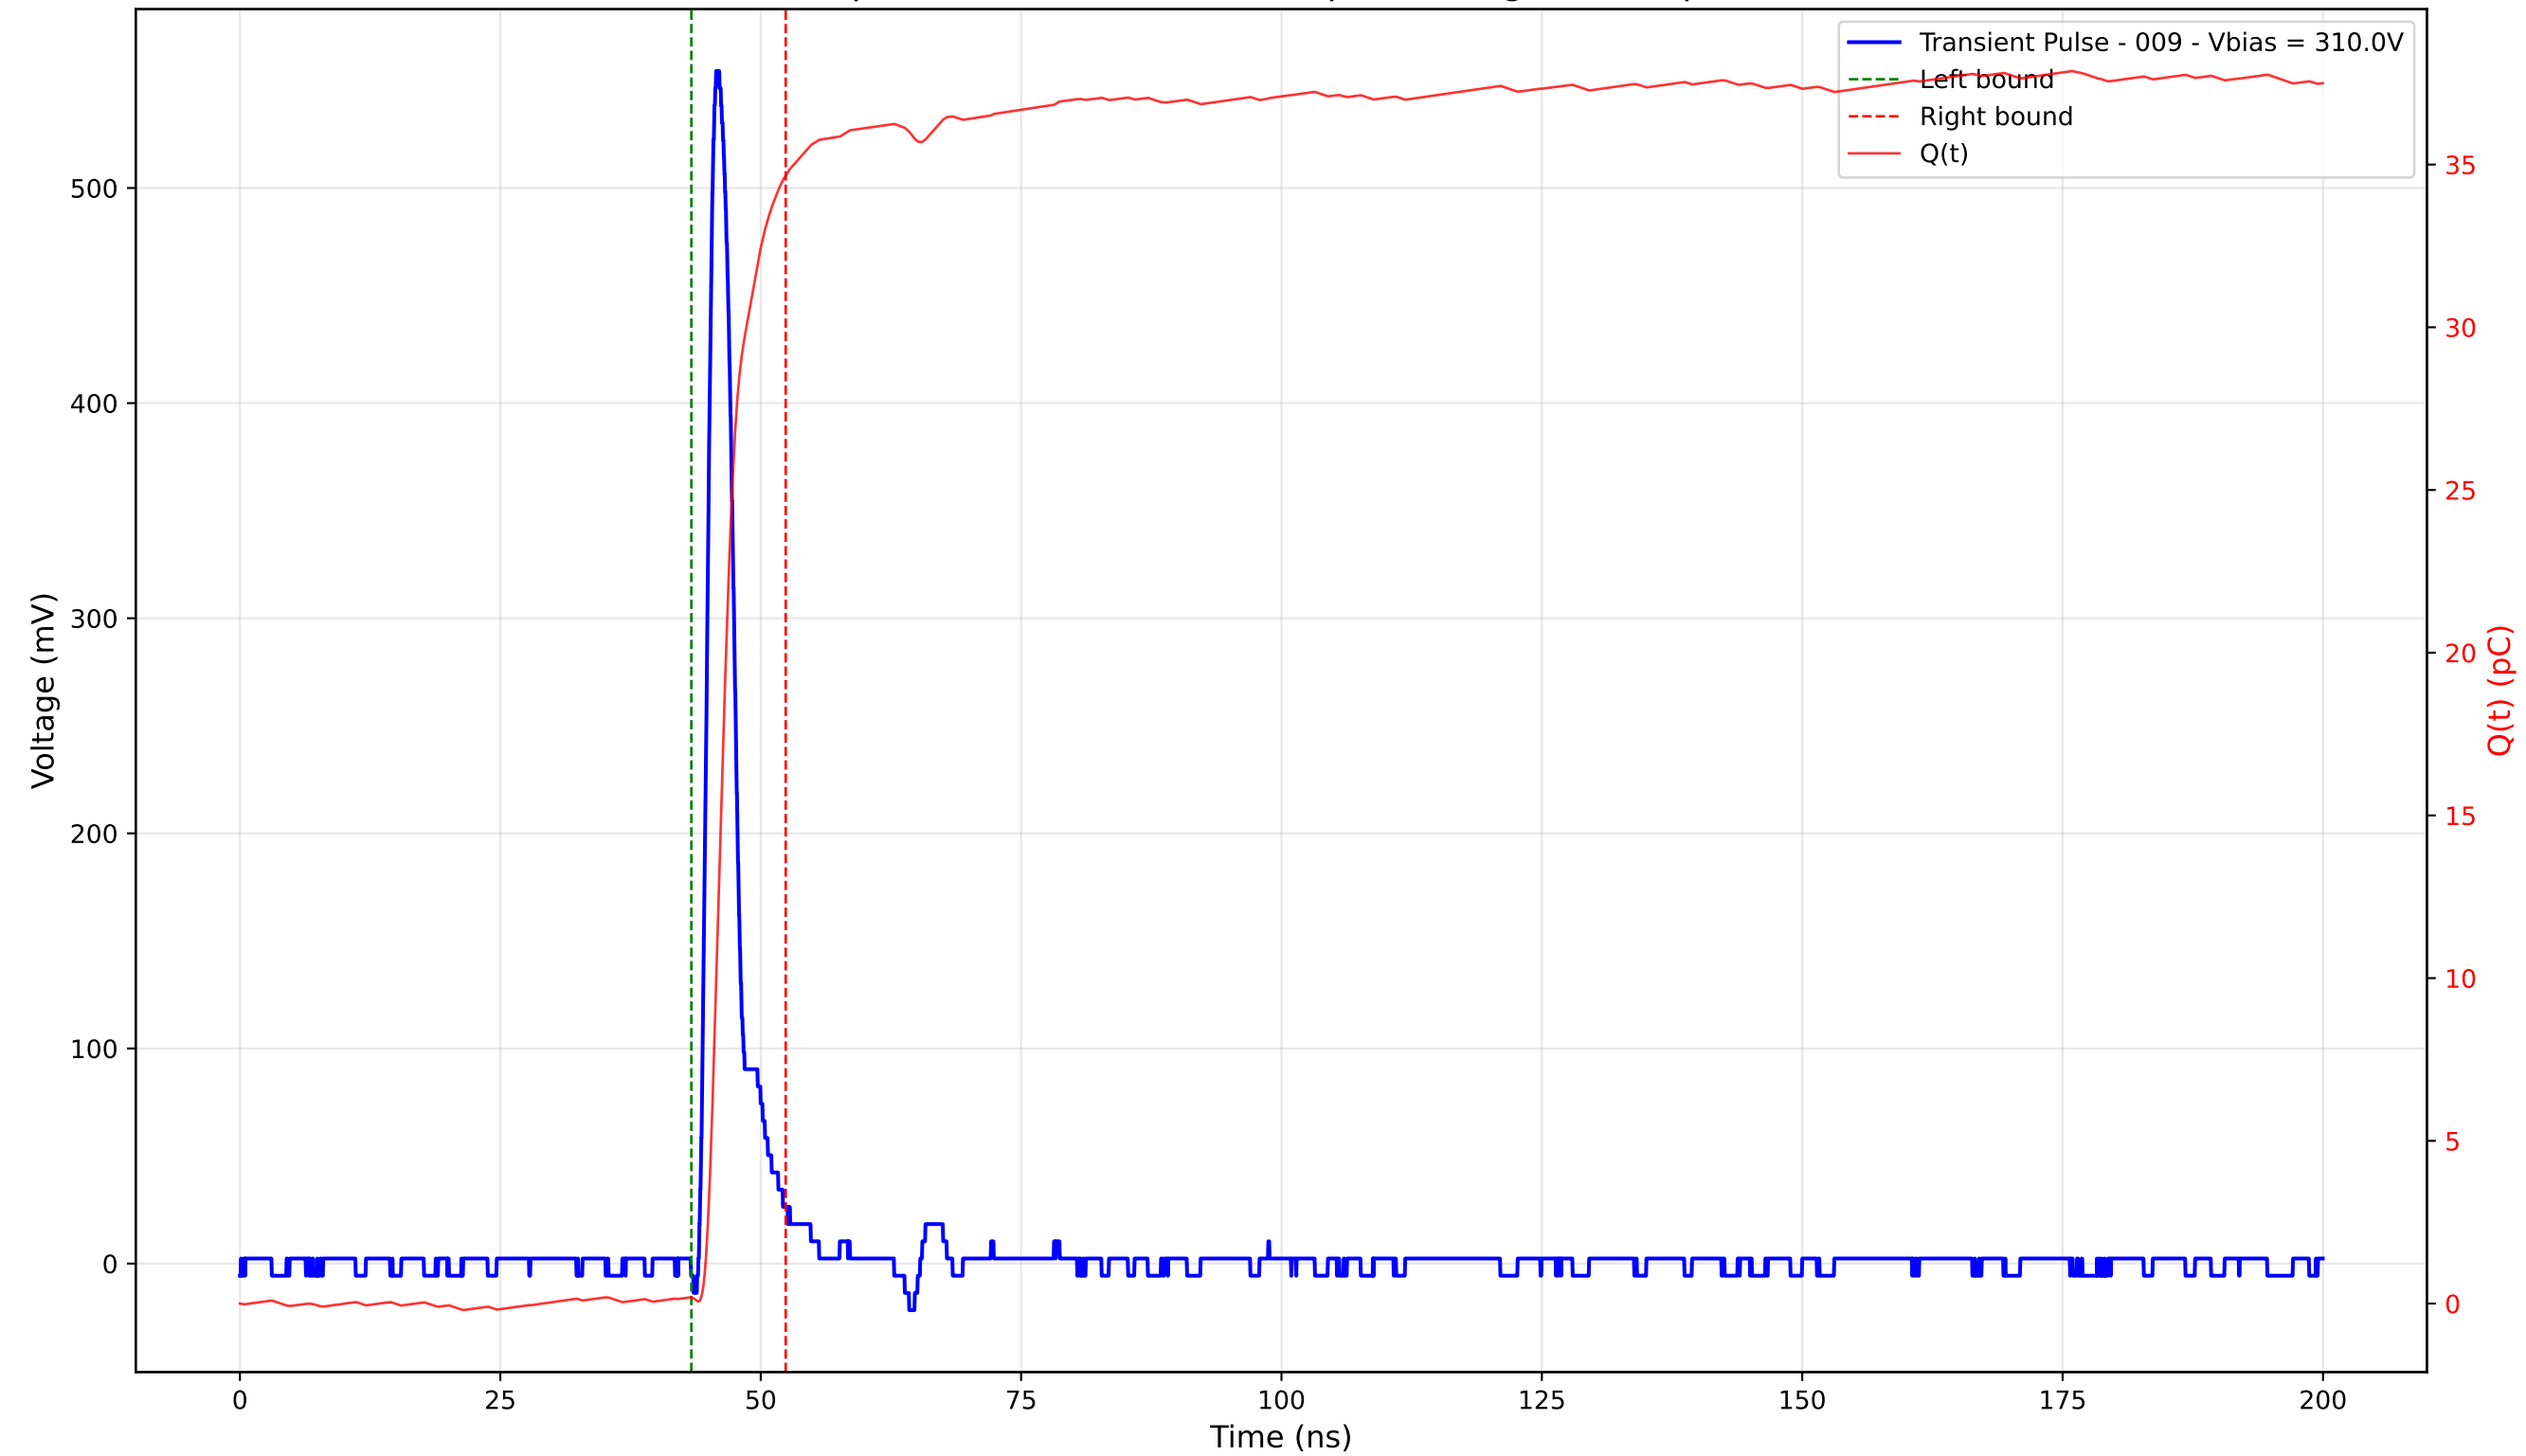


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 34.58 pC - Rise Time: 1.09 ns

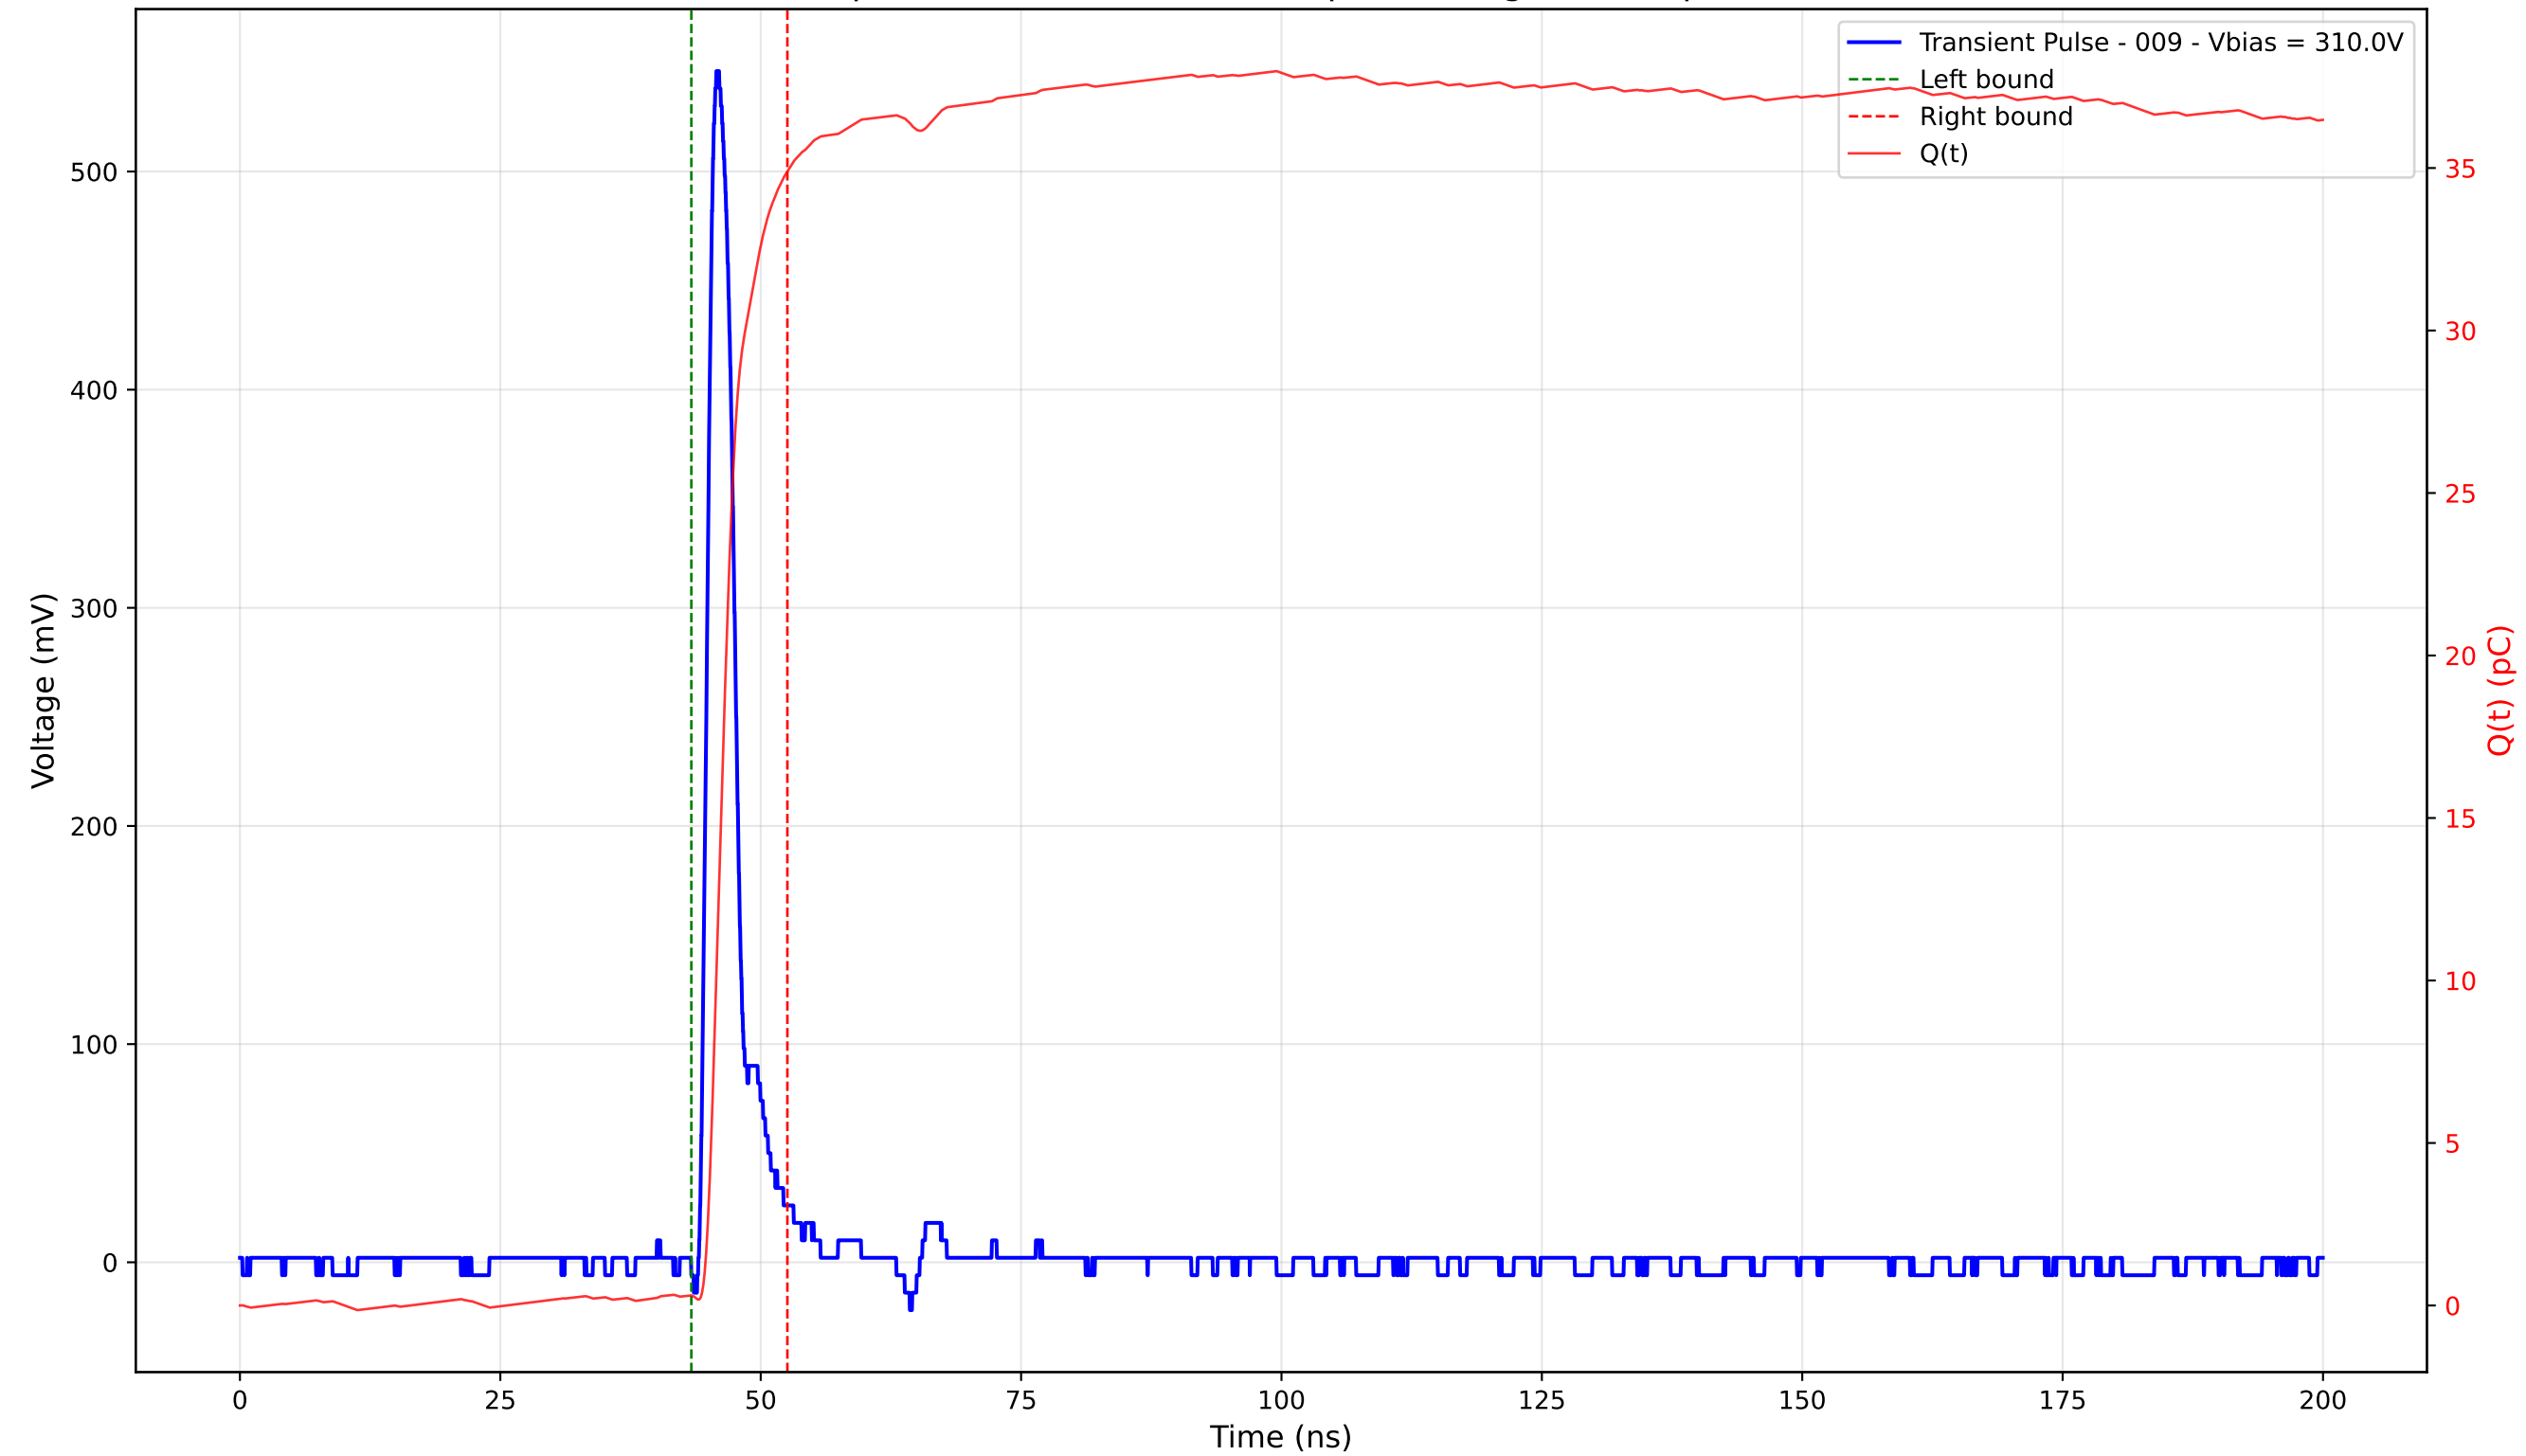


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 33.48 pC - Rise Time: 1.09 ns

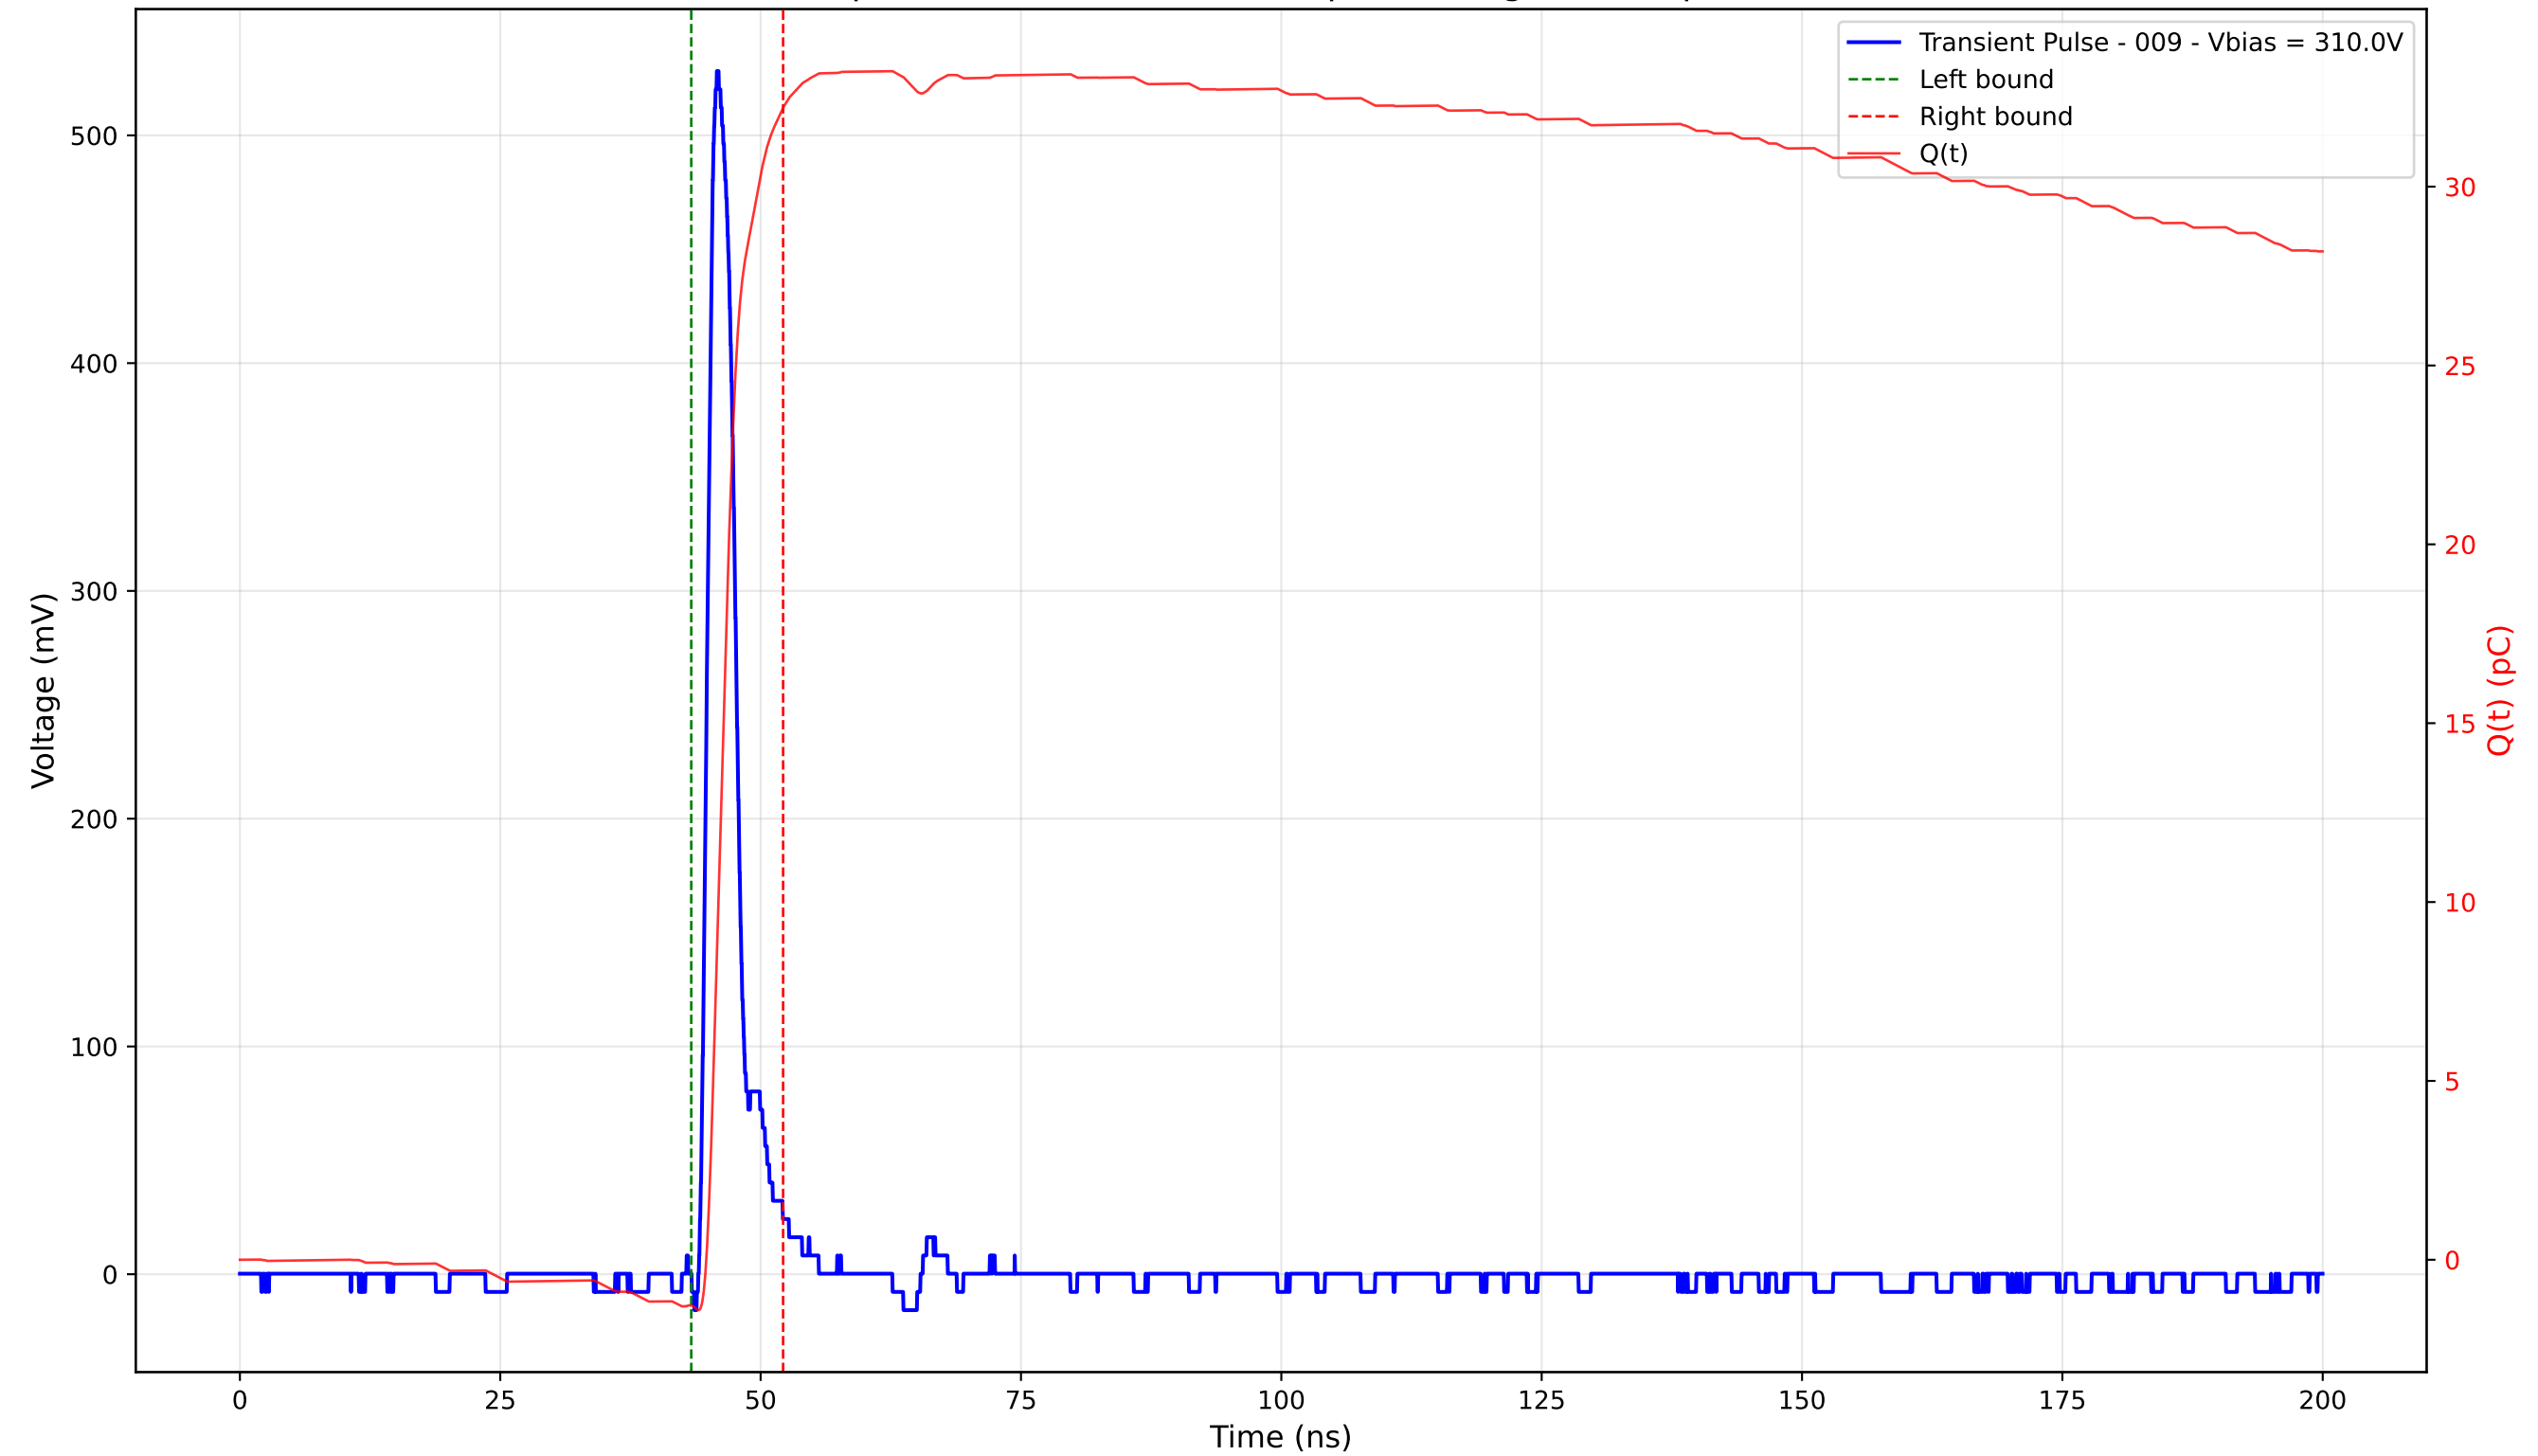


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 34.32 pC - Rise Time: 1.12 ns

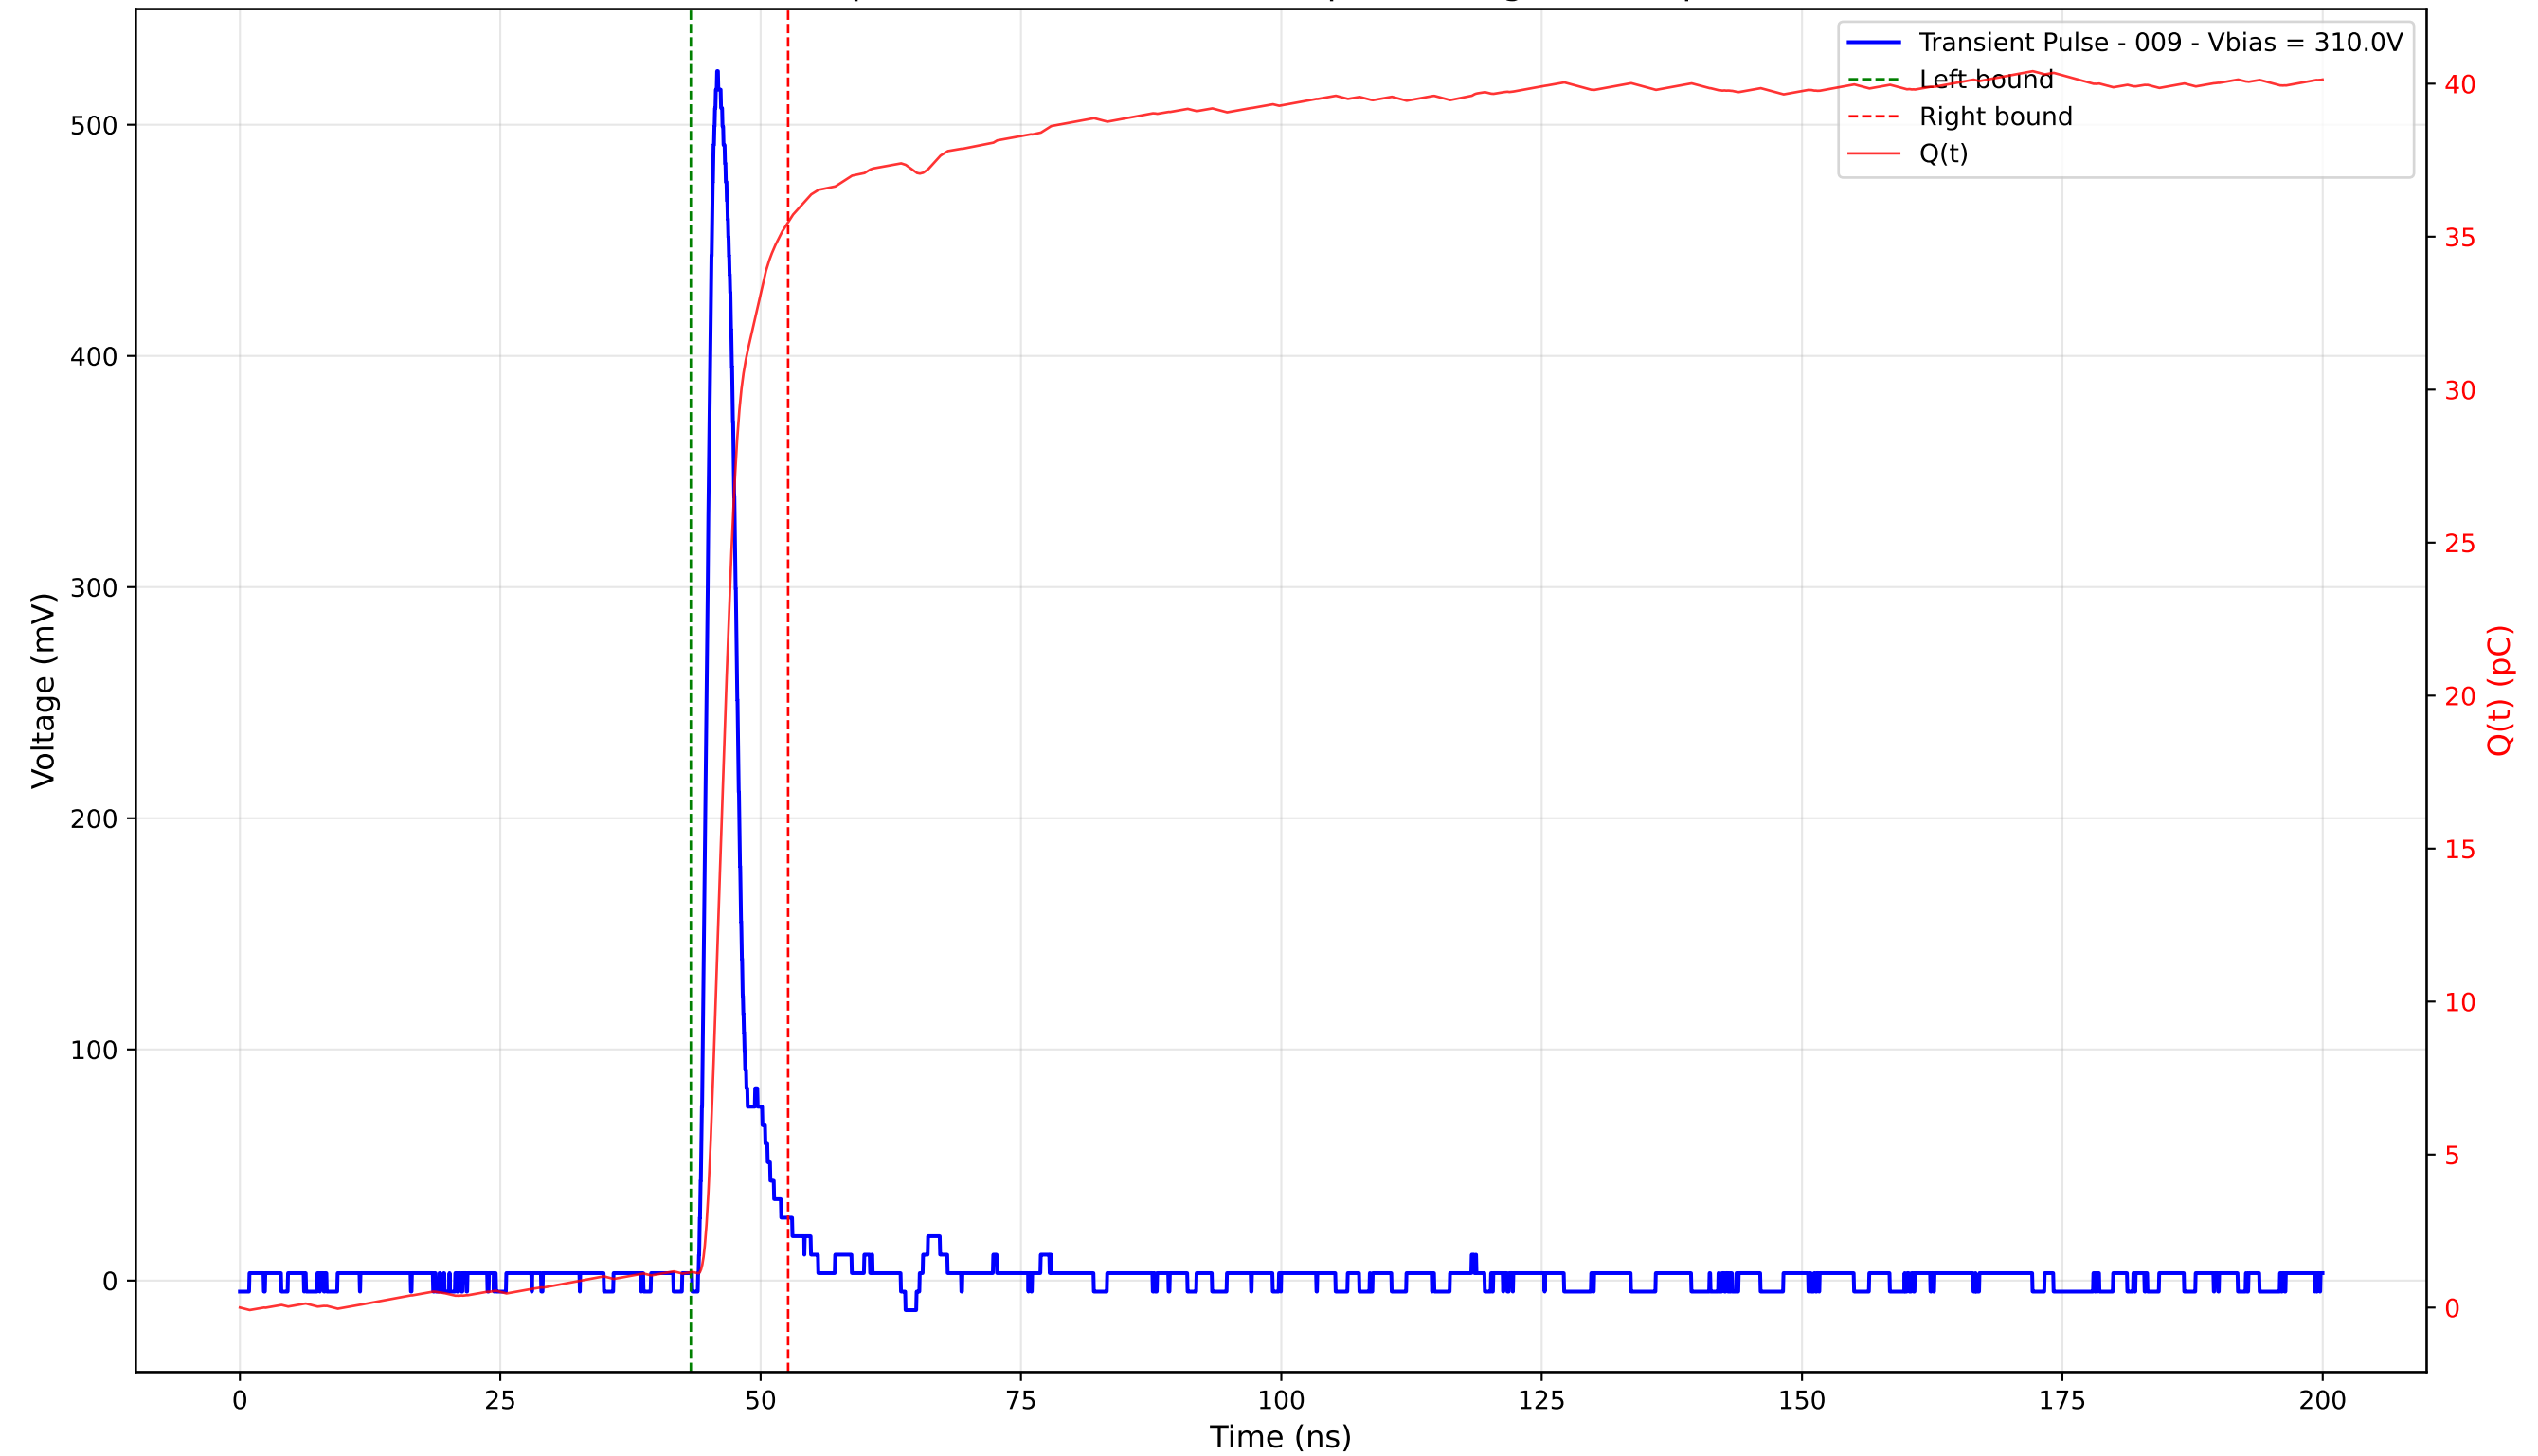


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 33.28 pC - Rise Time: 1.08 ns

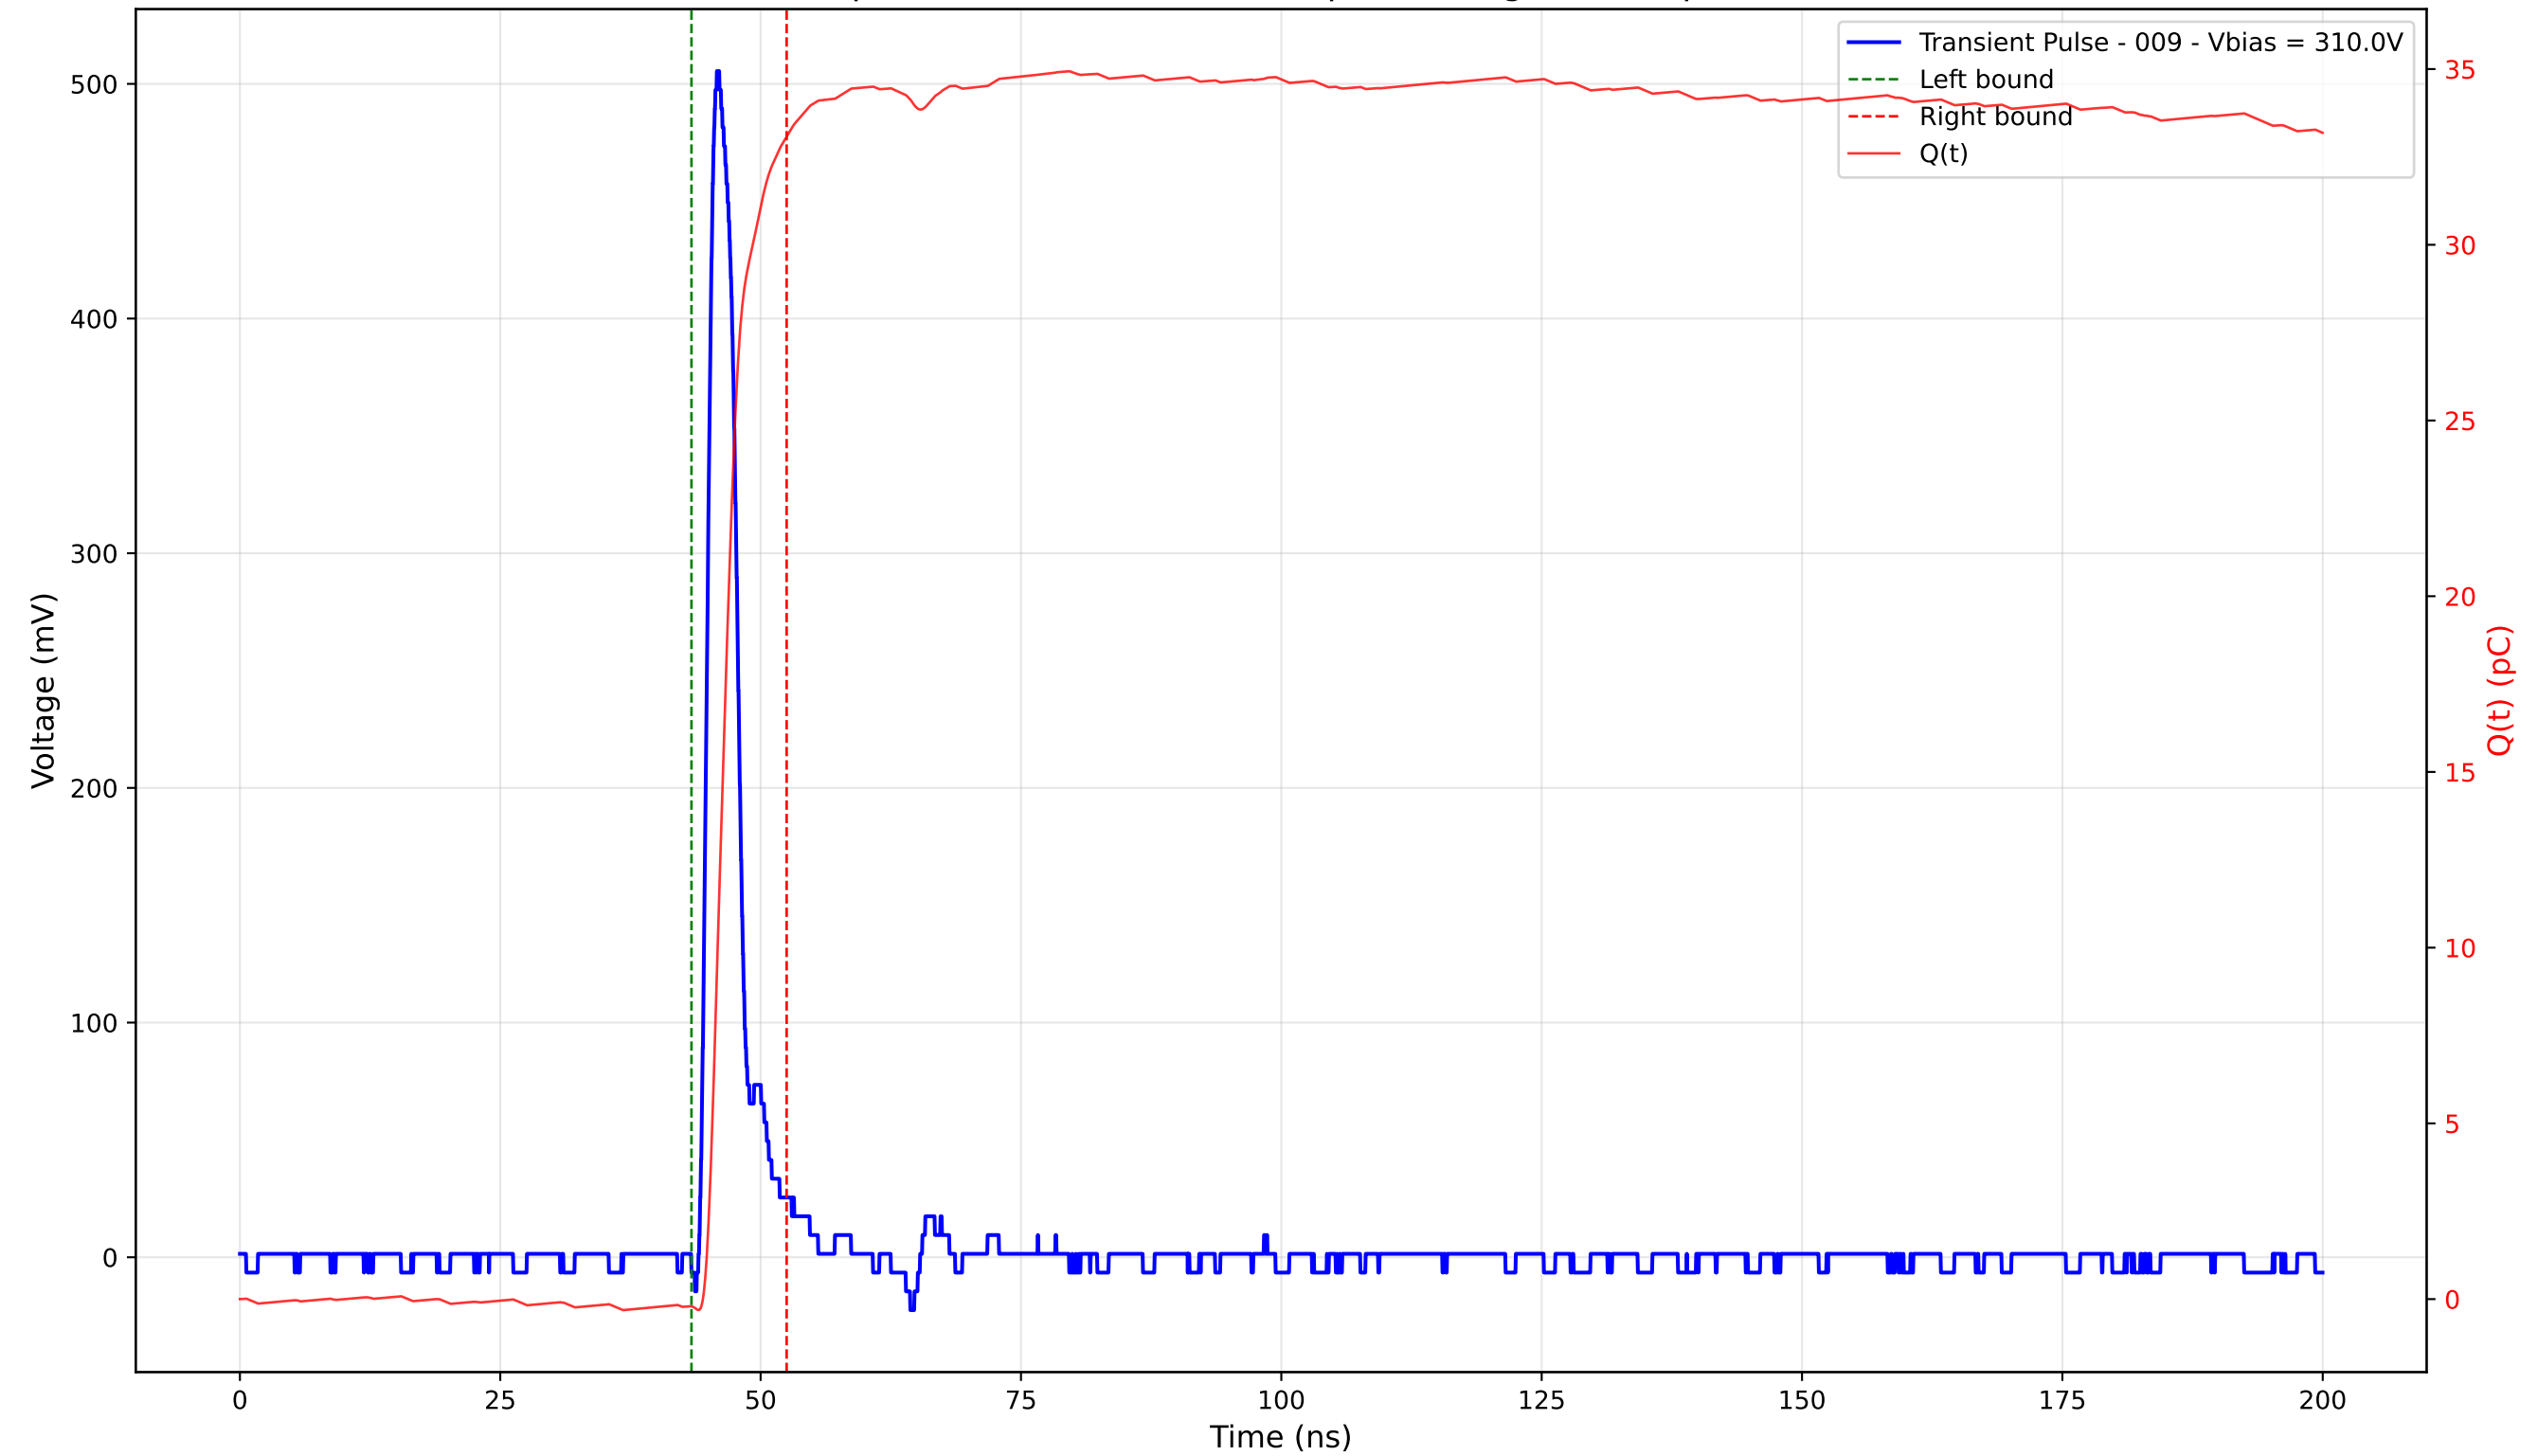


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 32.84 pC - Rise Time: 1.08 ns

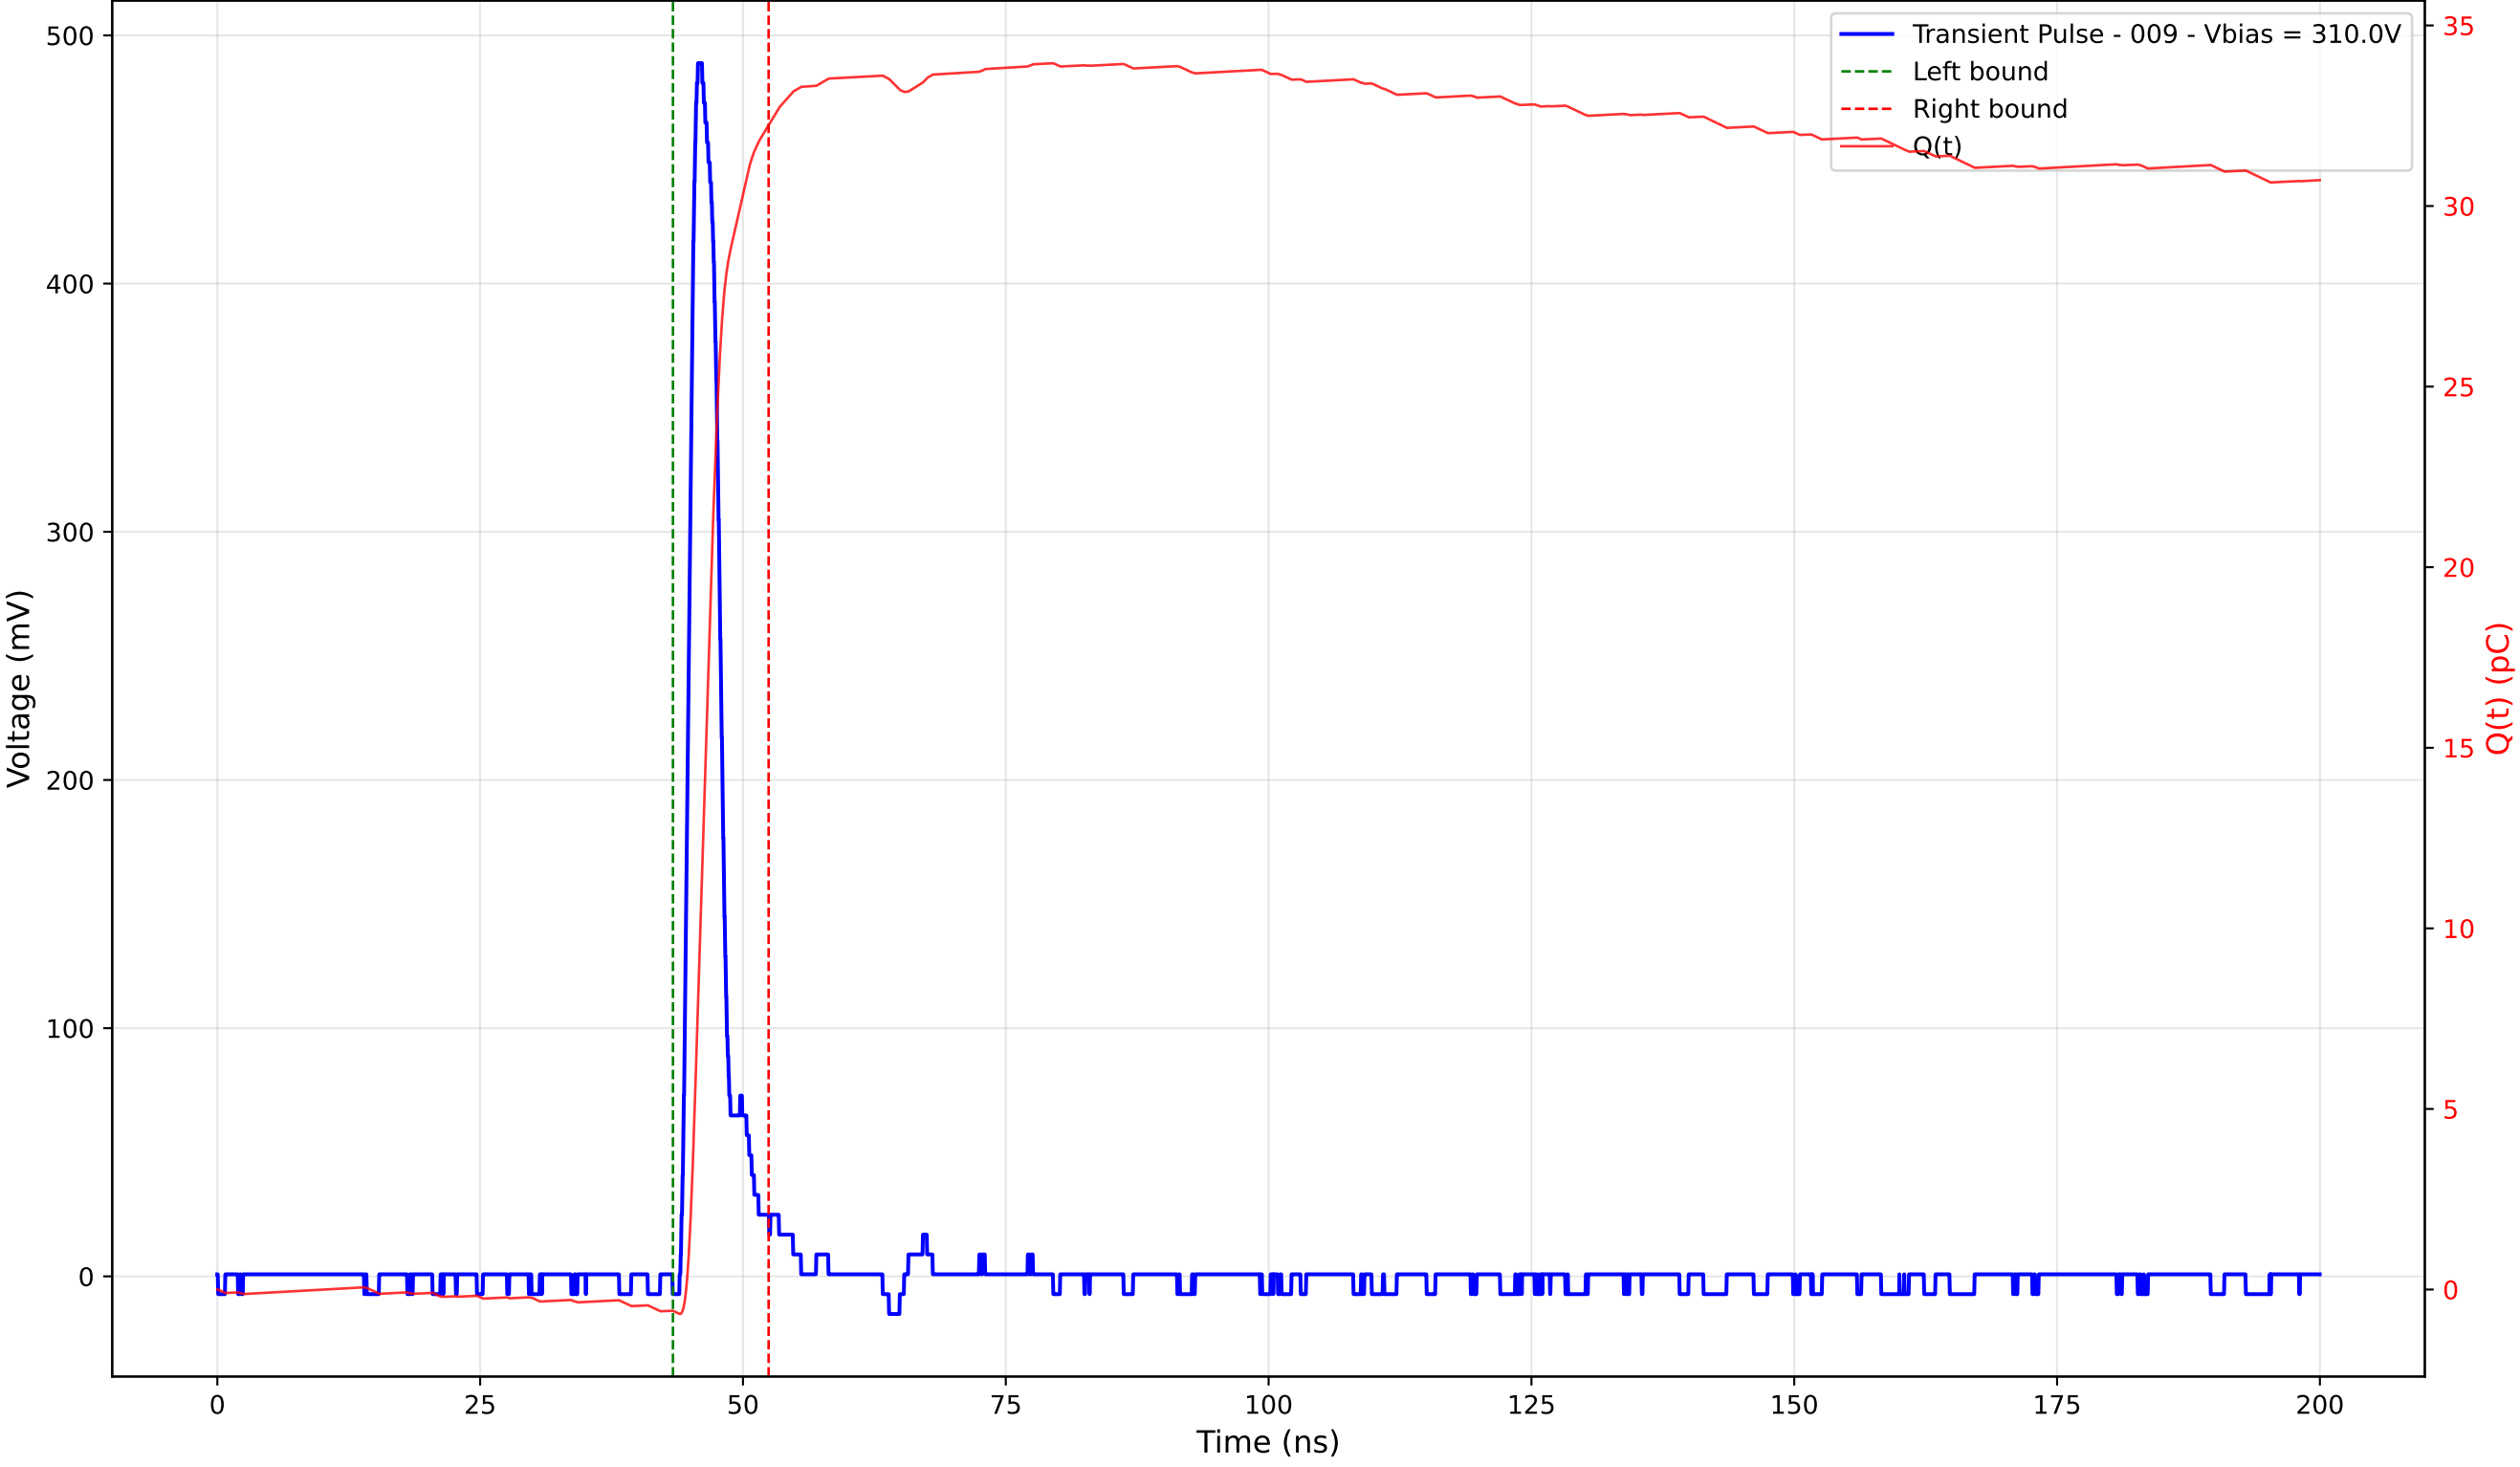


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 33.09 pC - Rise Time: 1.04 ns

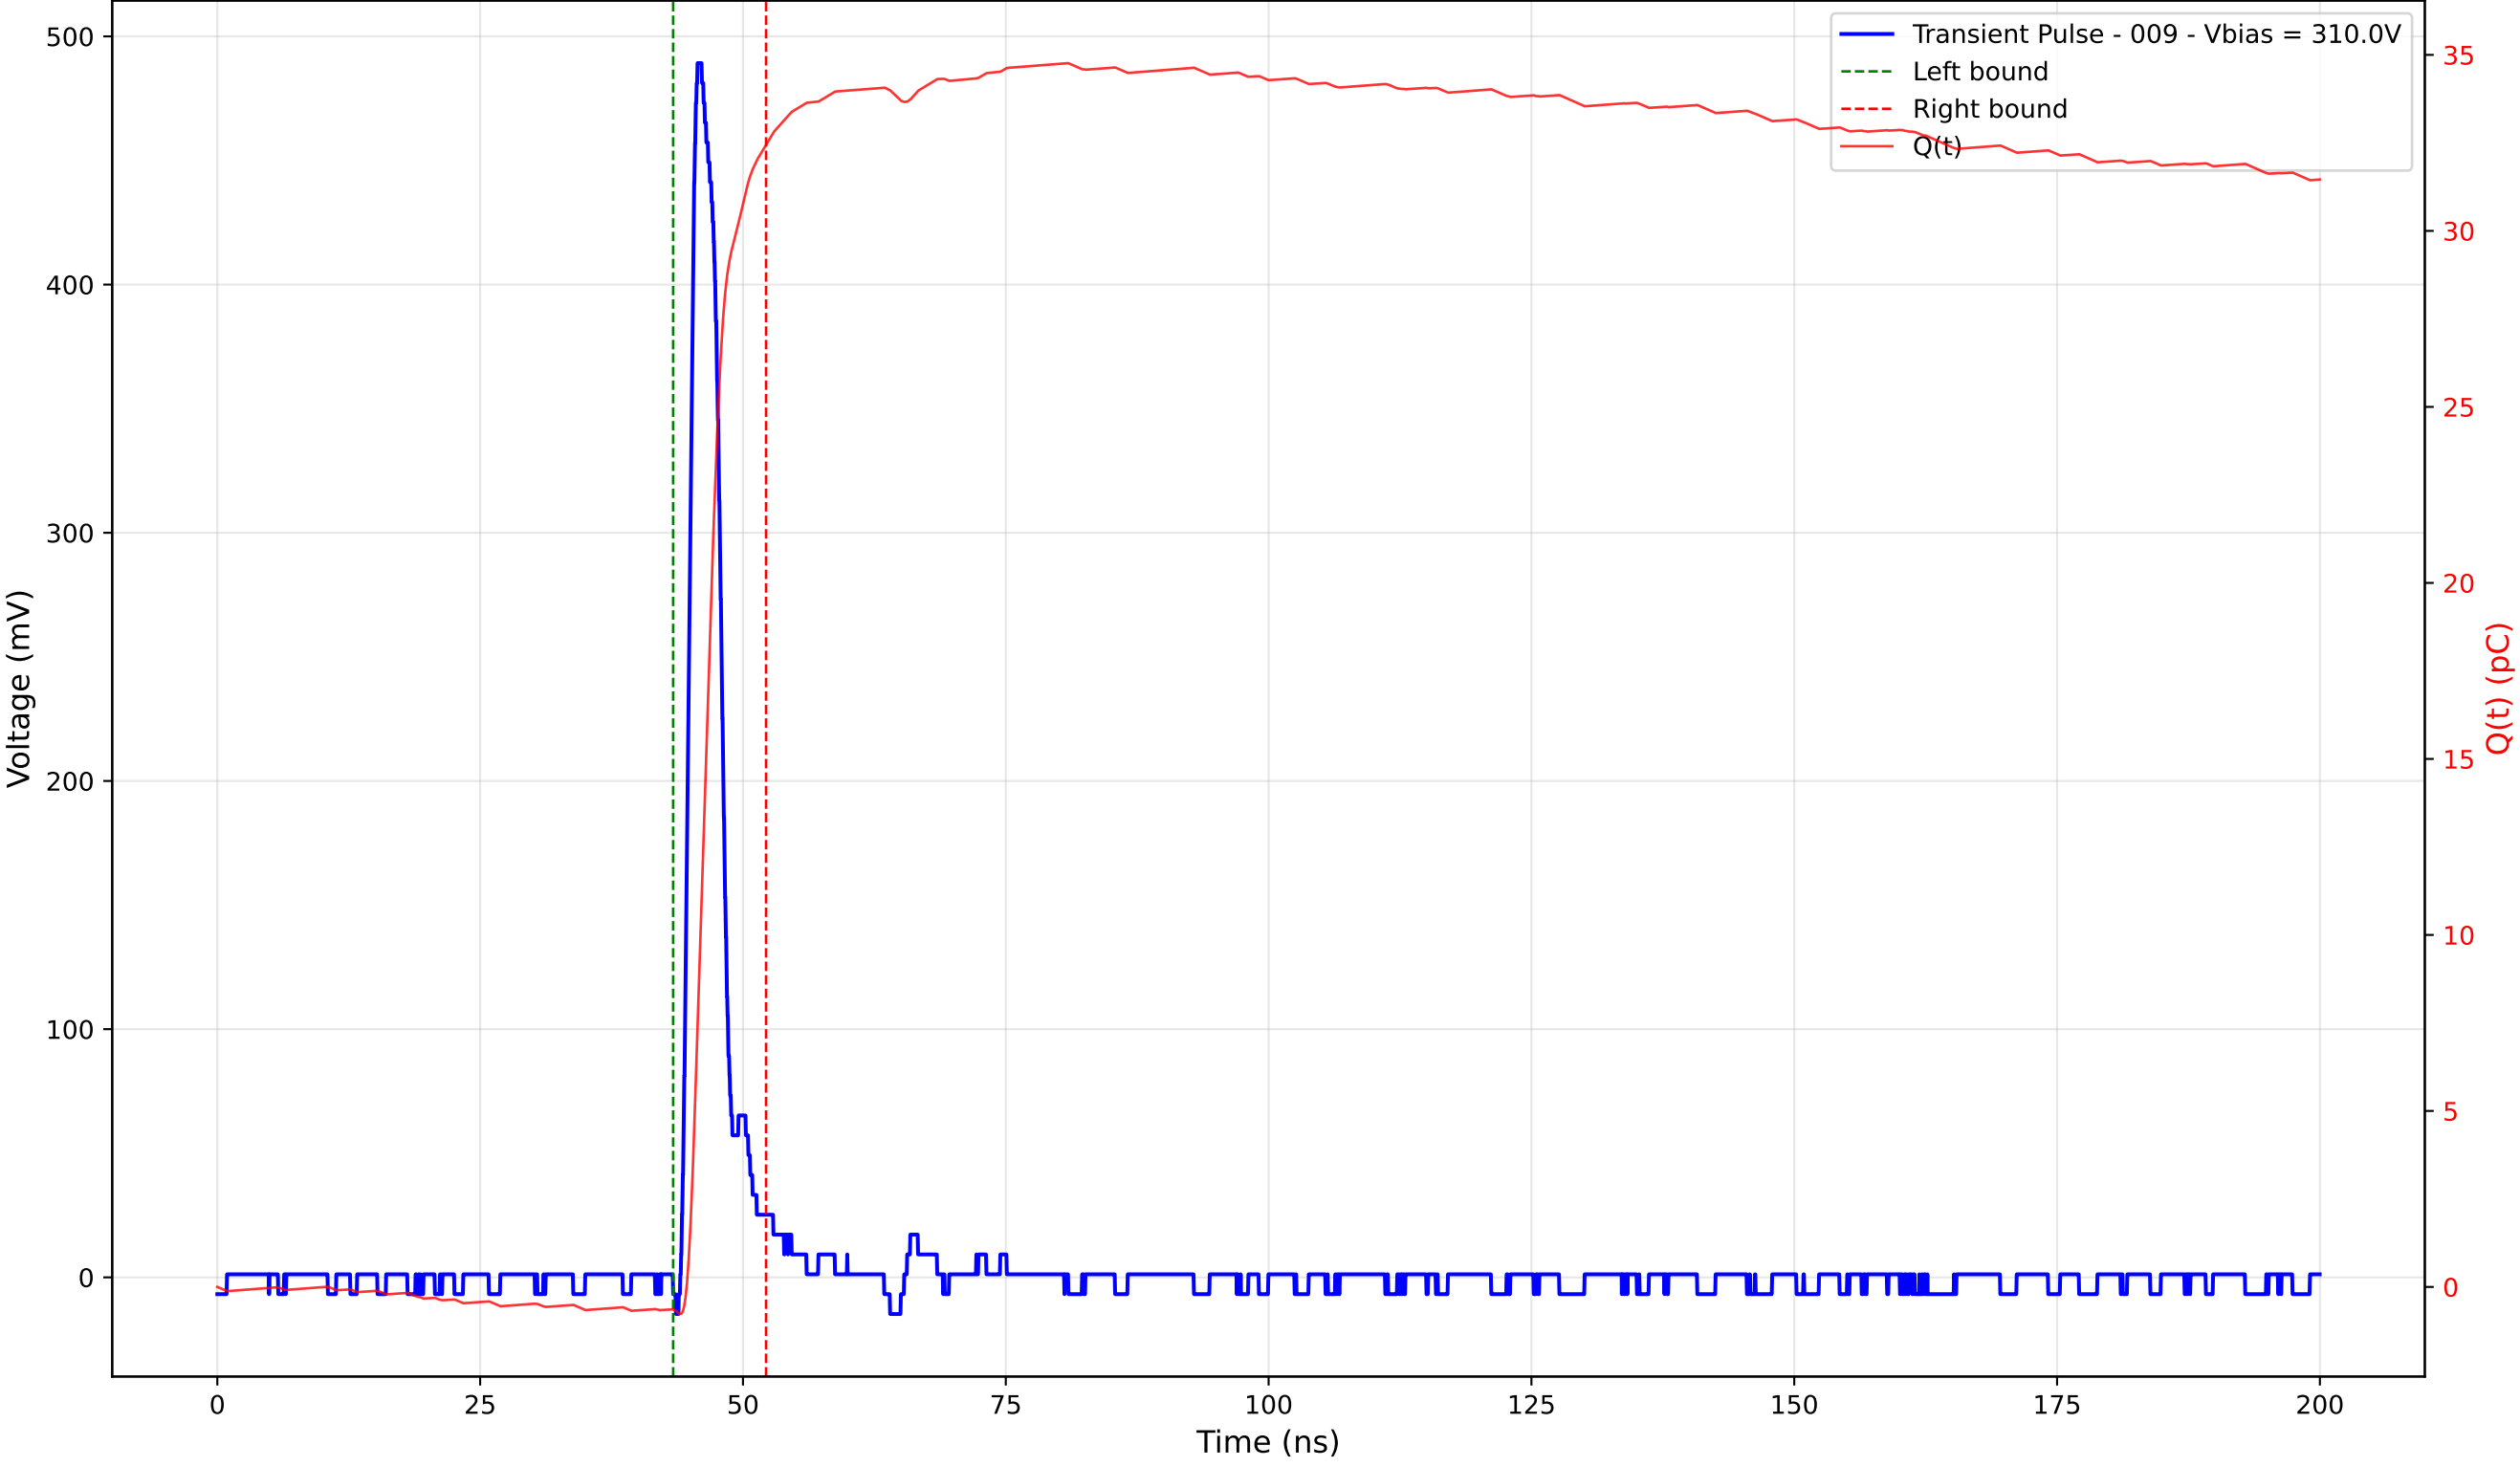


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 33.05 pC - Rise Time: 1.10 ns

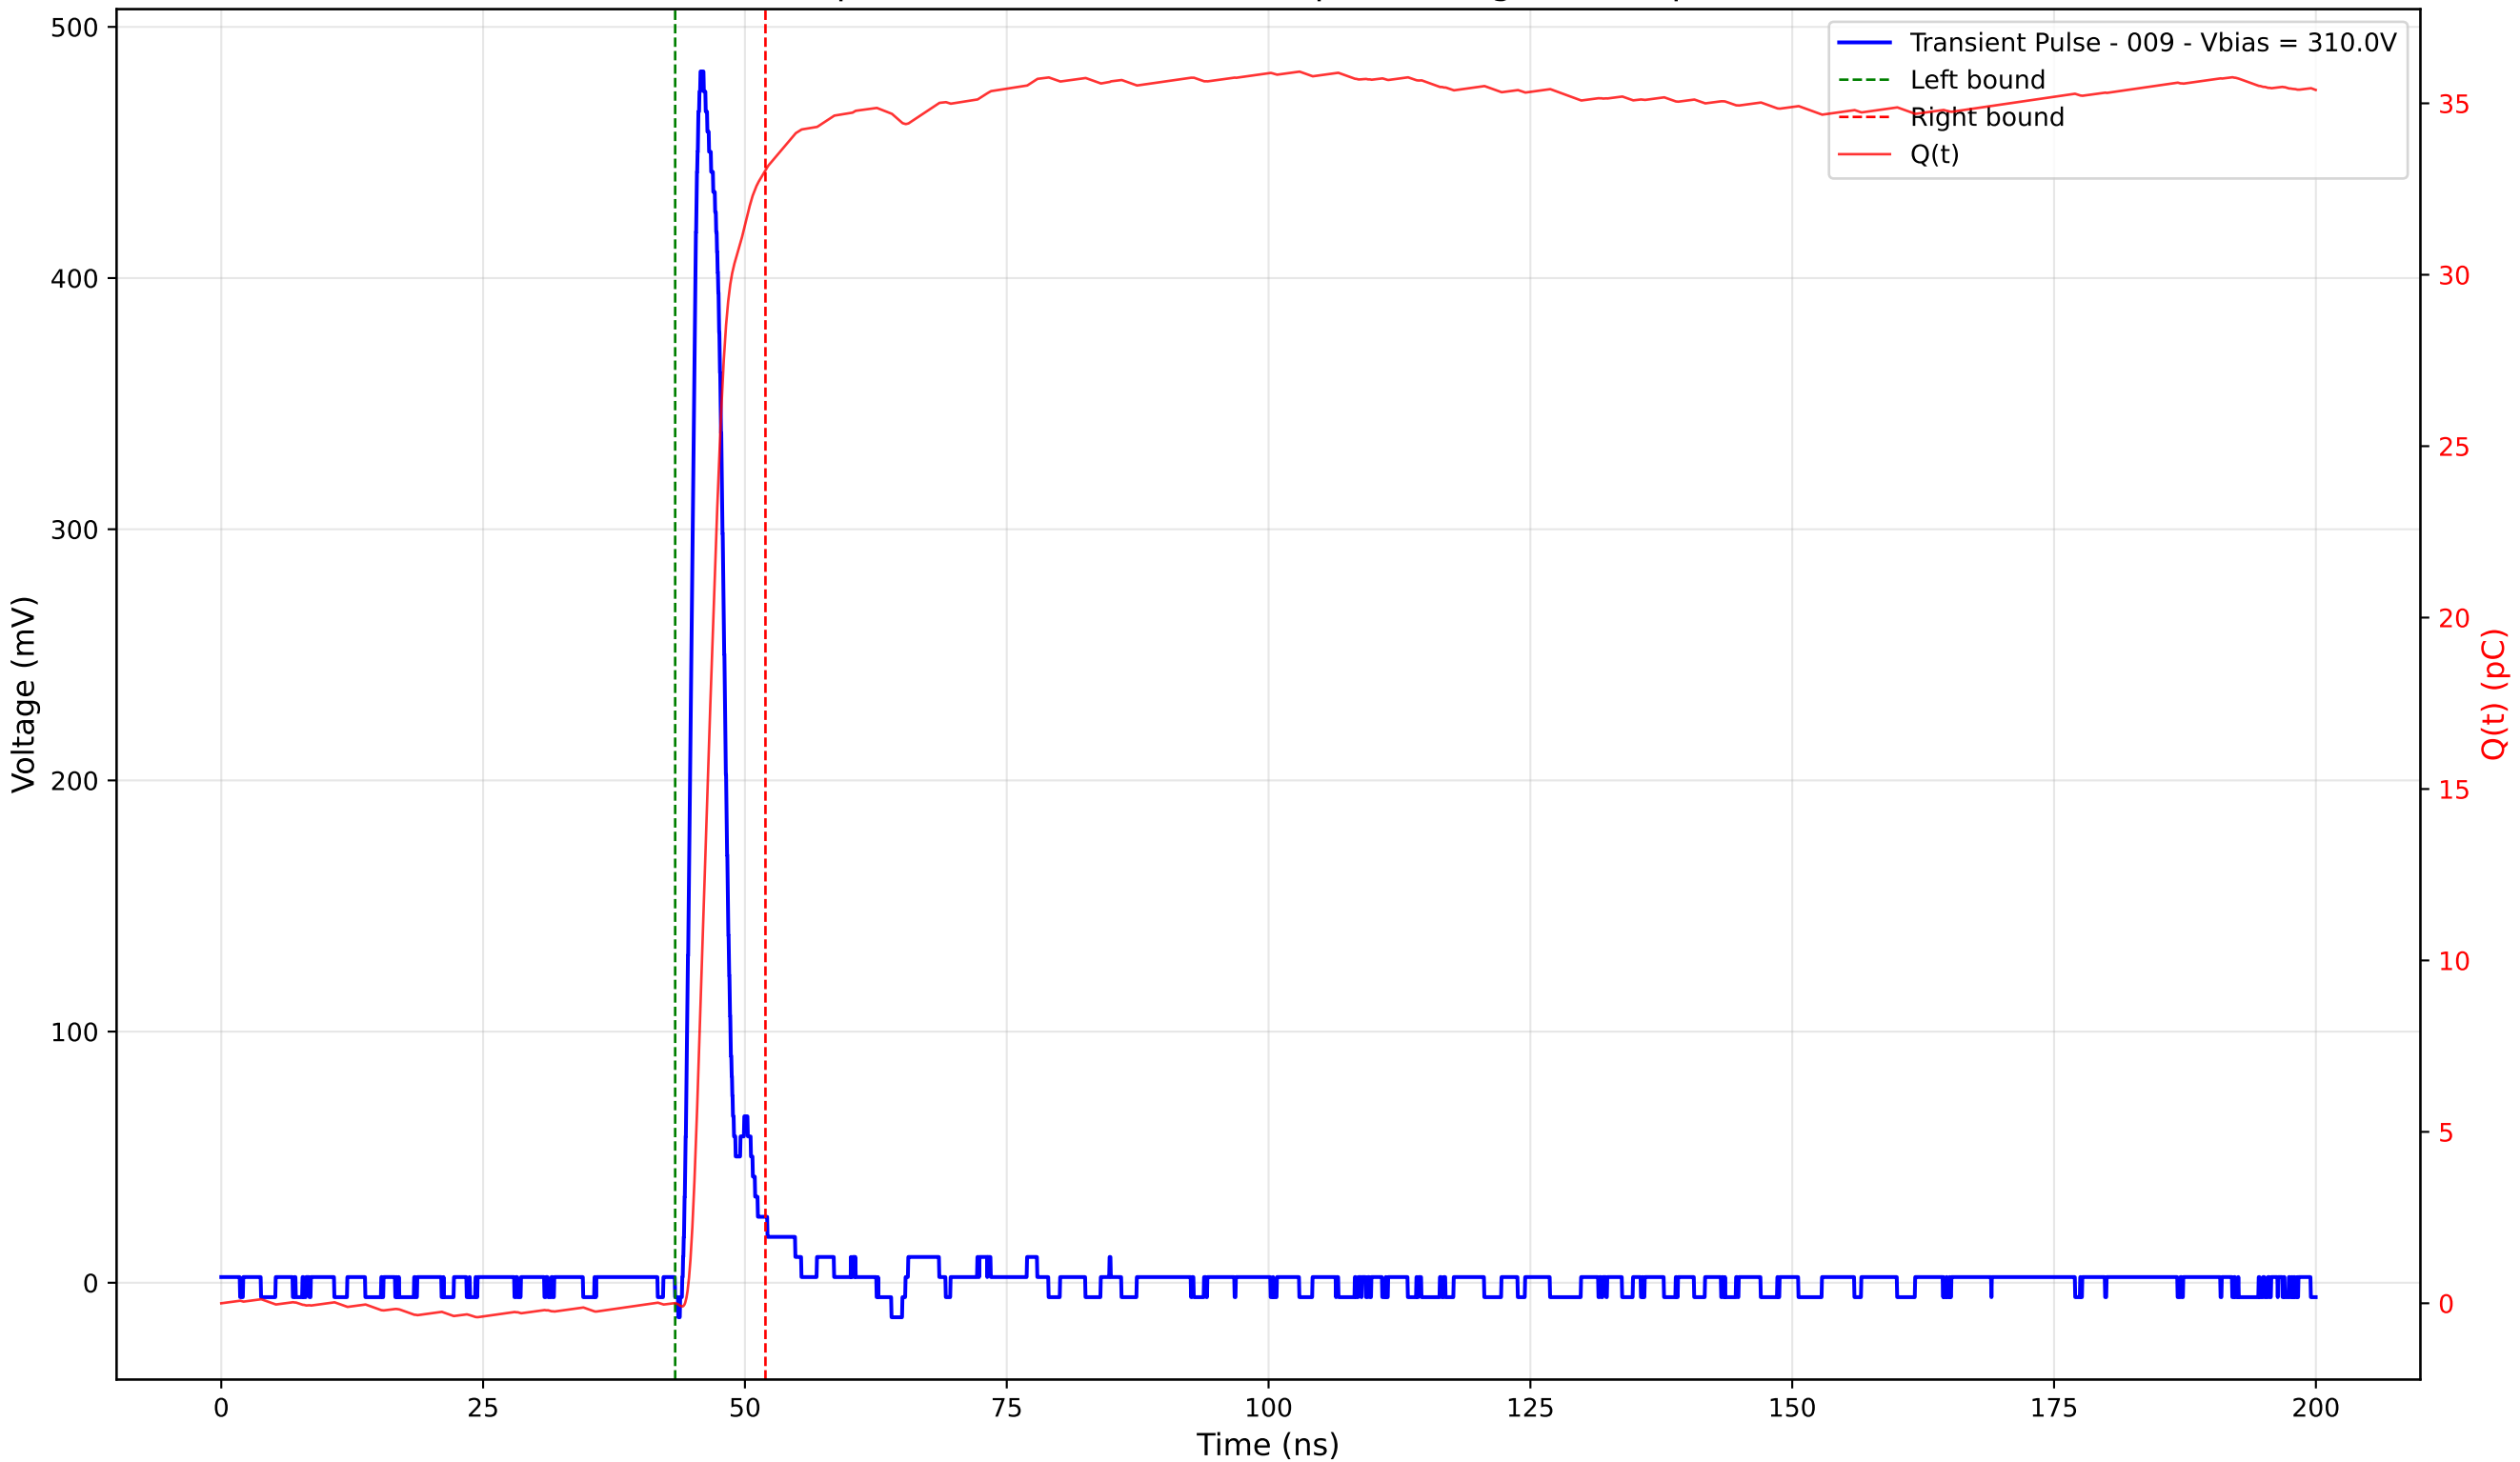


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 32.93 pC - Rise Time: 1.10 ns

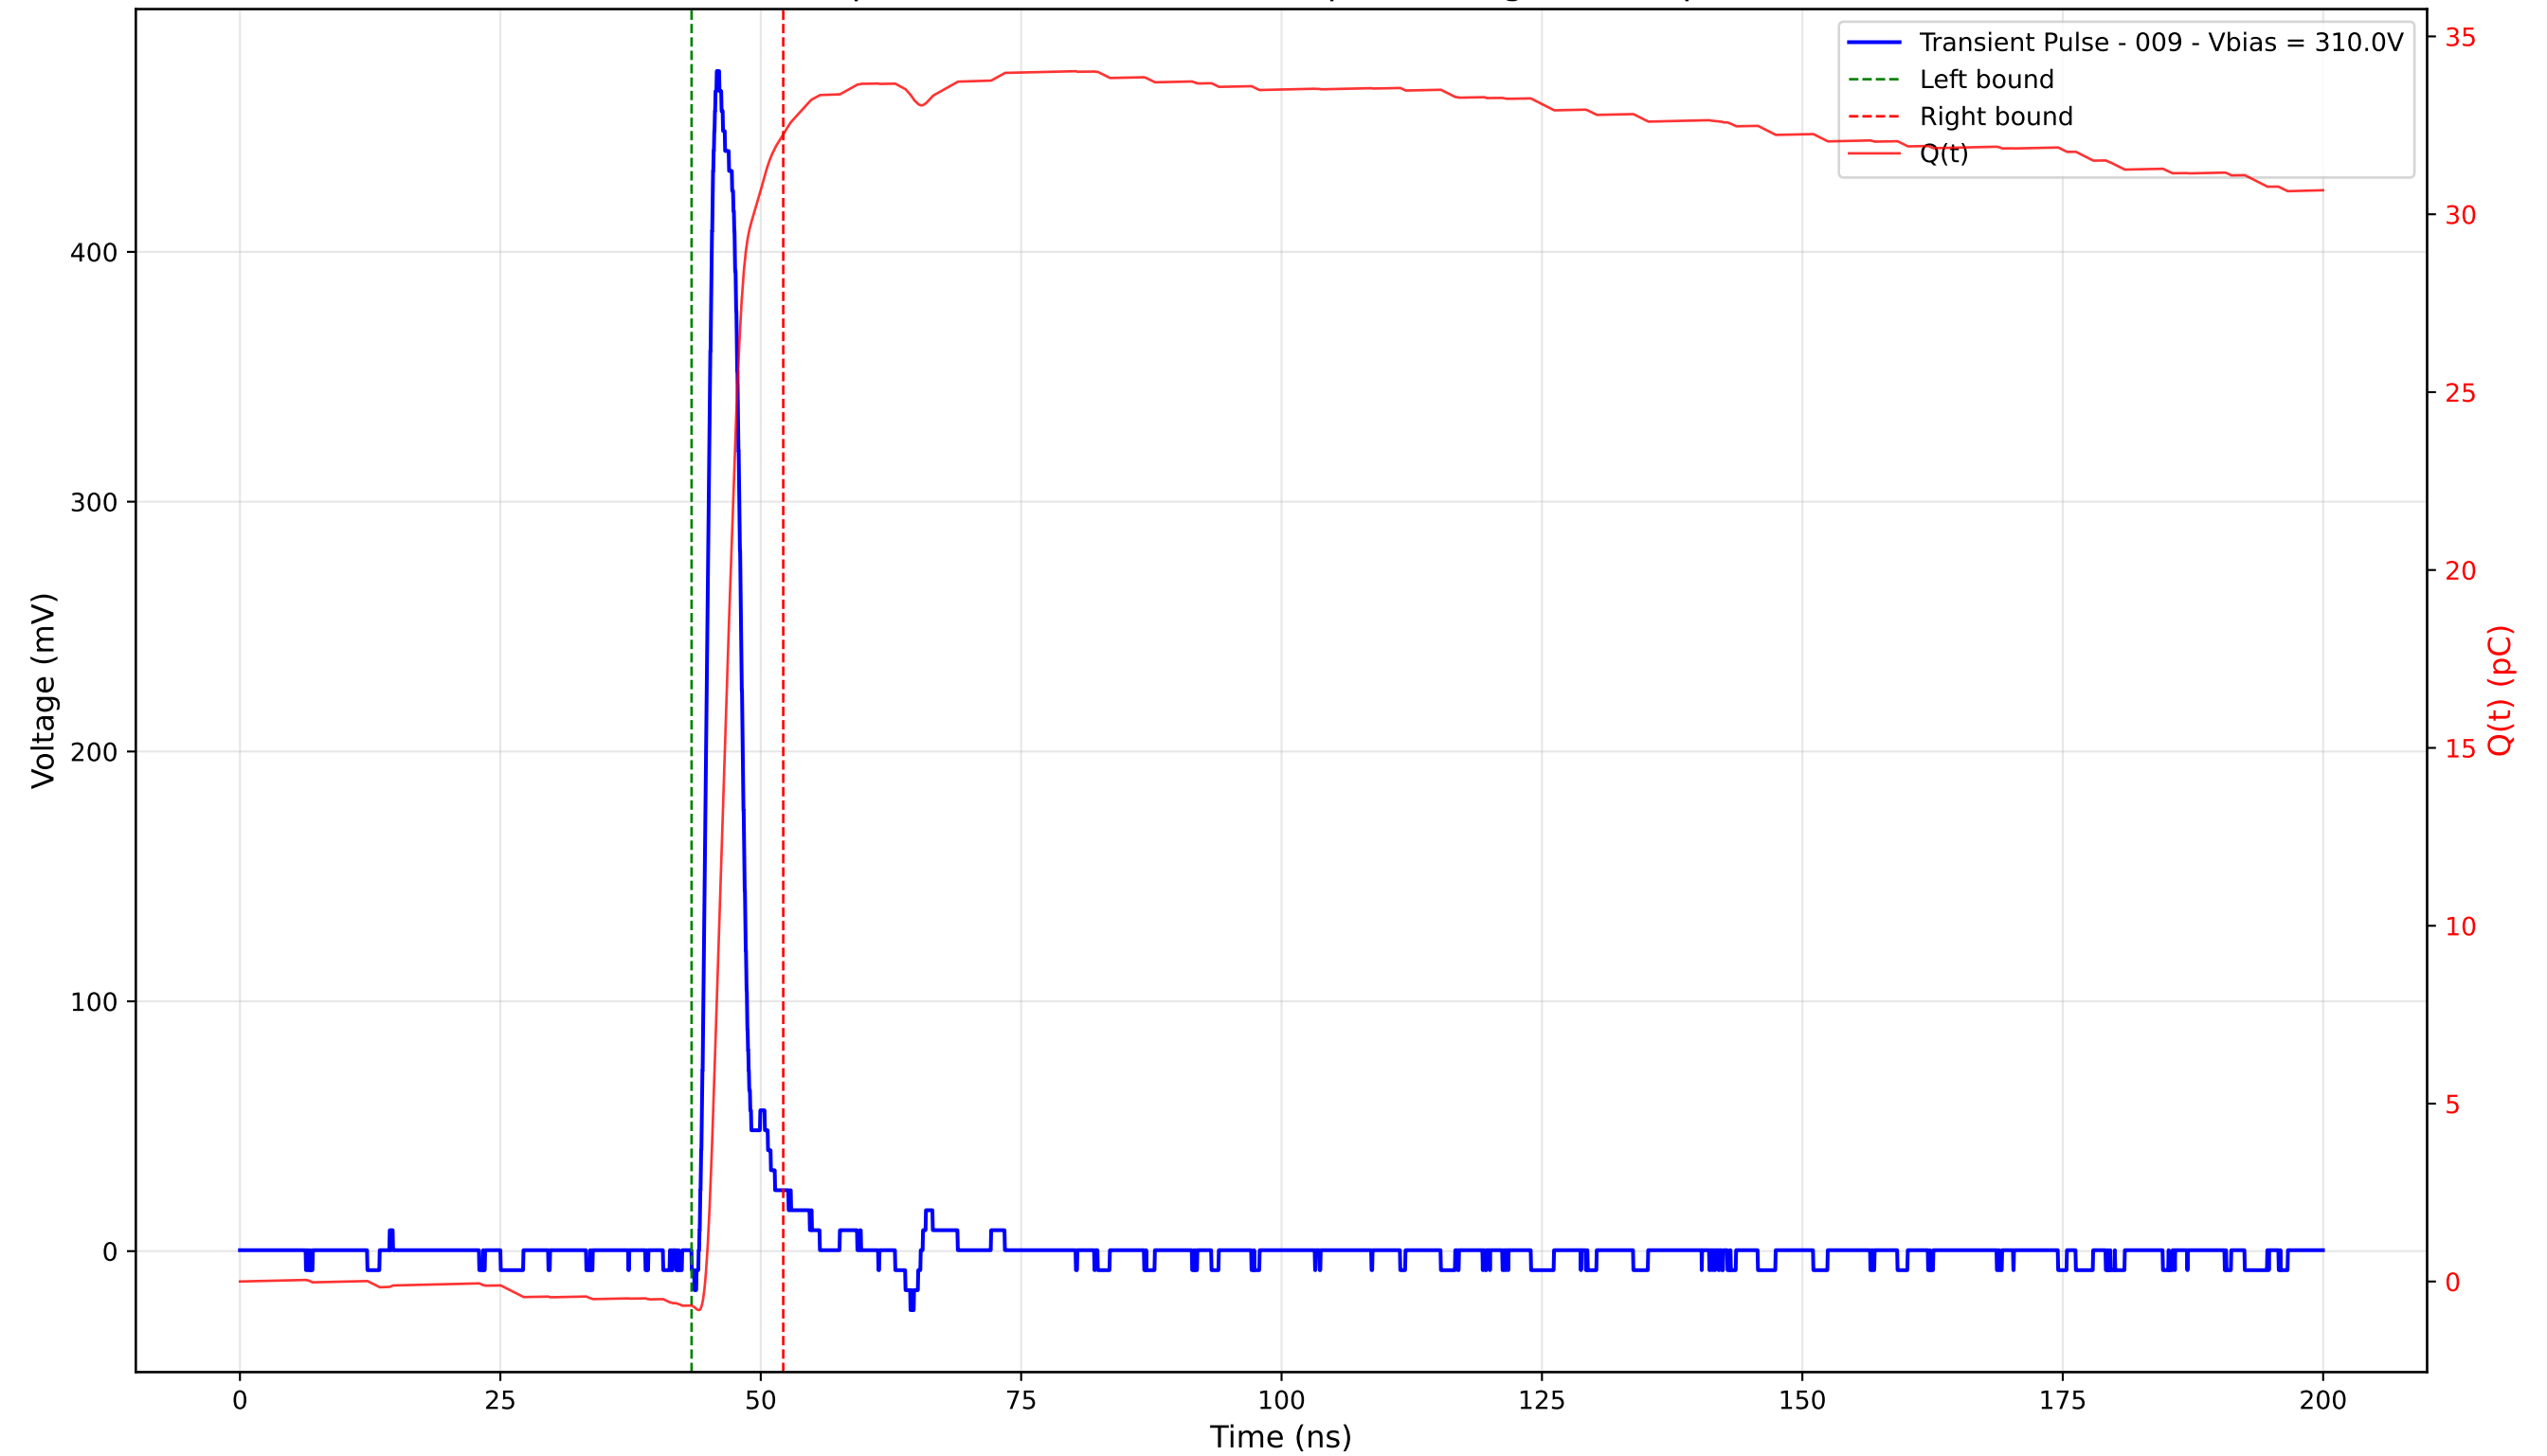


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 33.22 pC - Rise Time: 1.12 ns

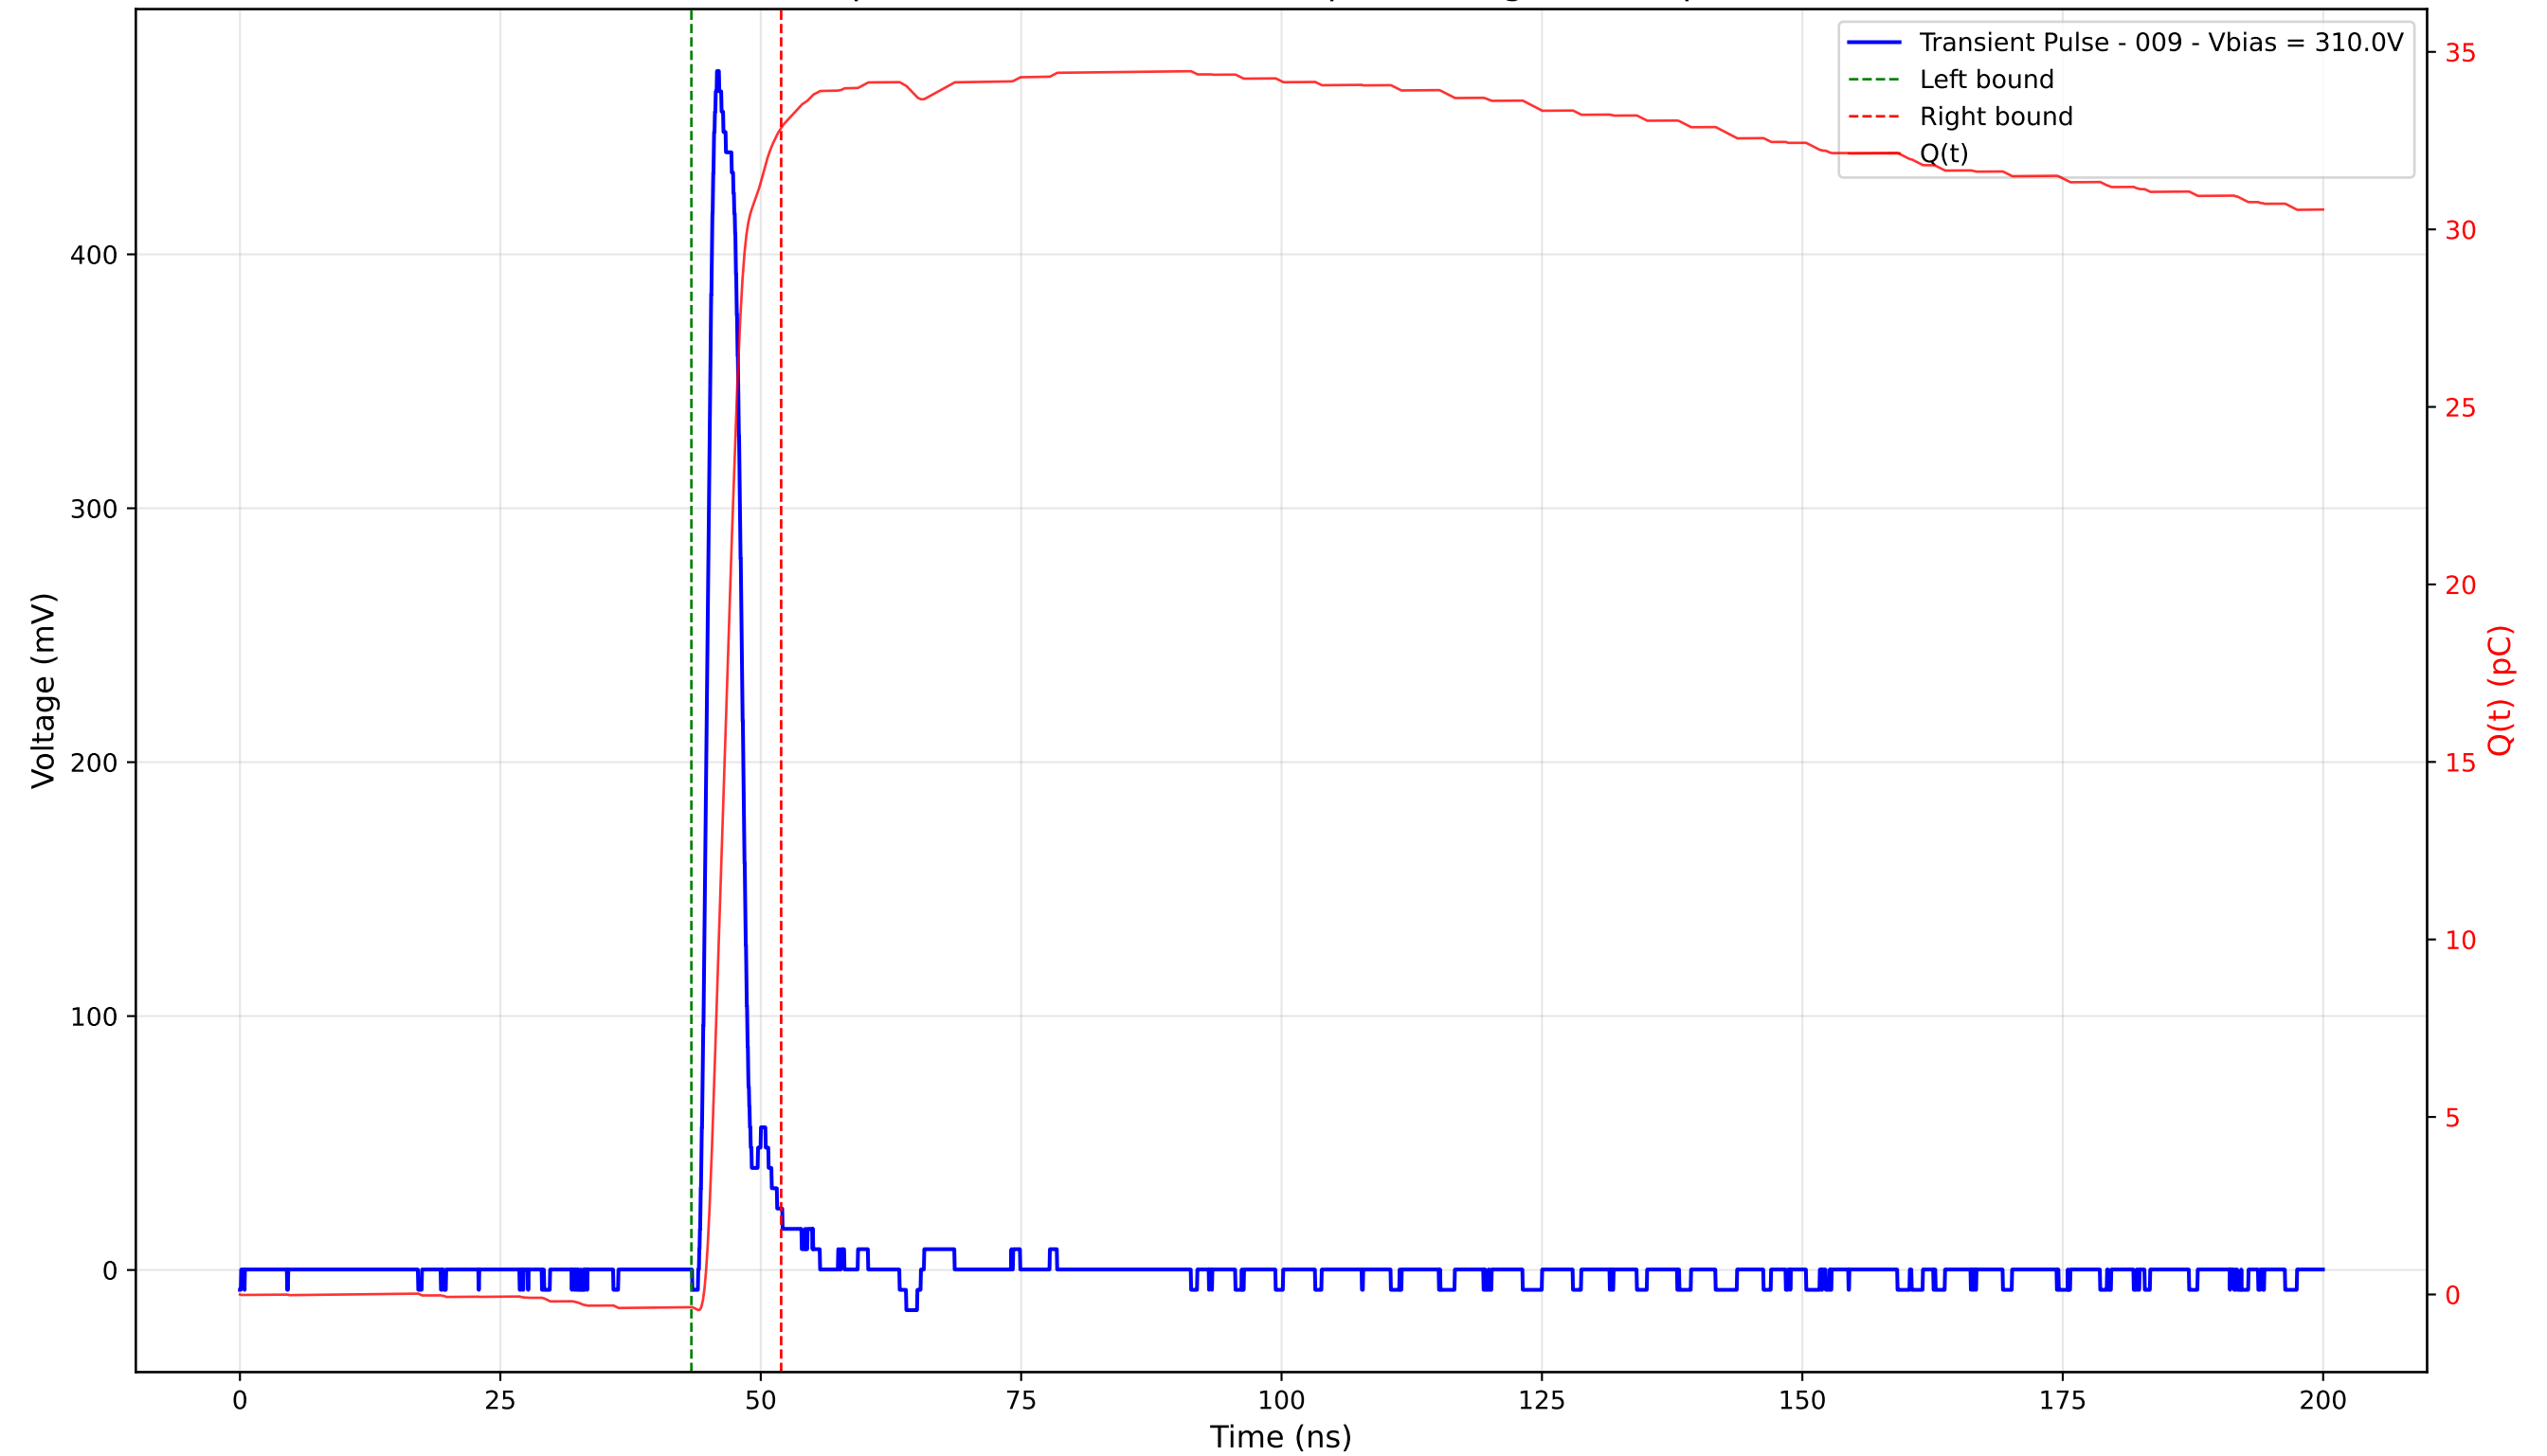


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 33.07 pC - Rise Time: 1.11 ns

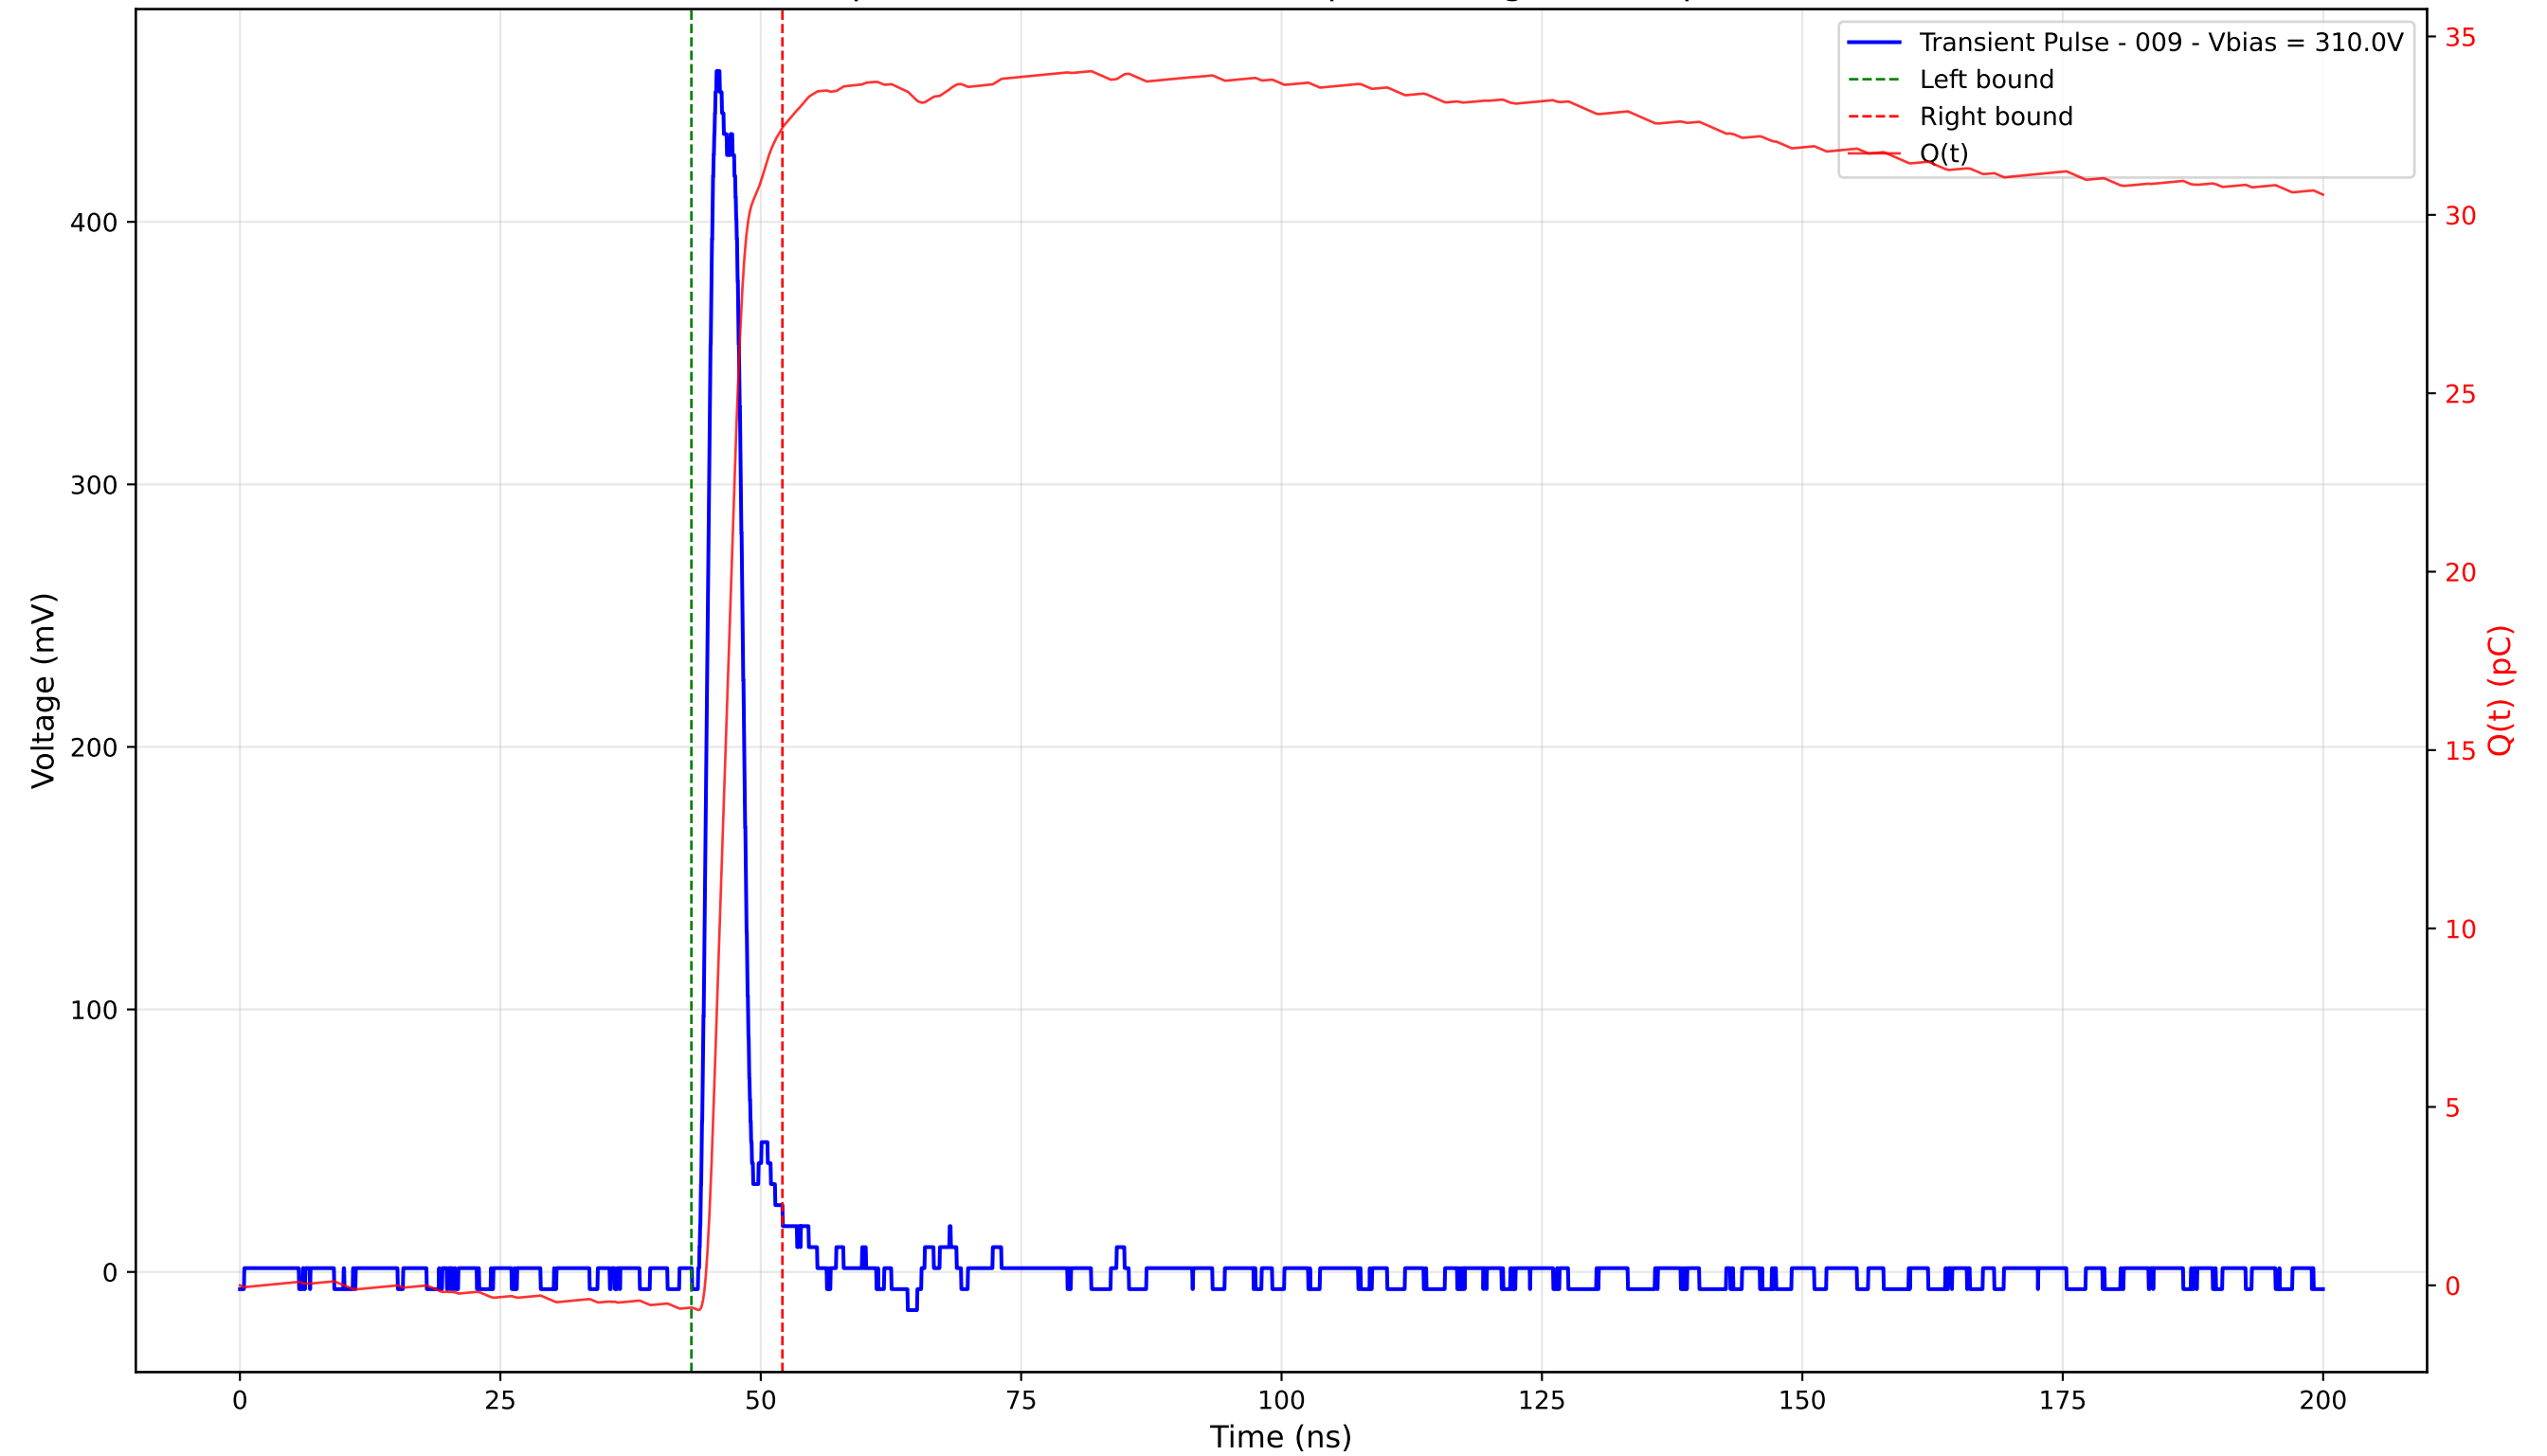


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 33.31 pC - Rise Time: 1.11 ns

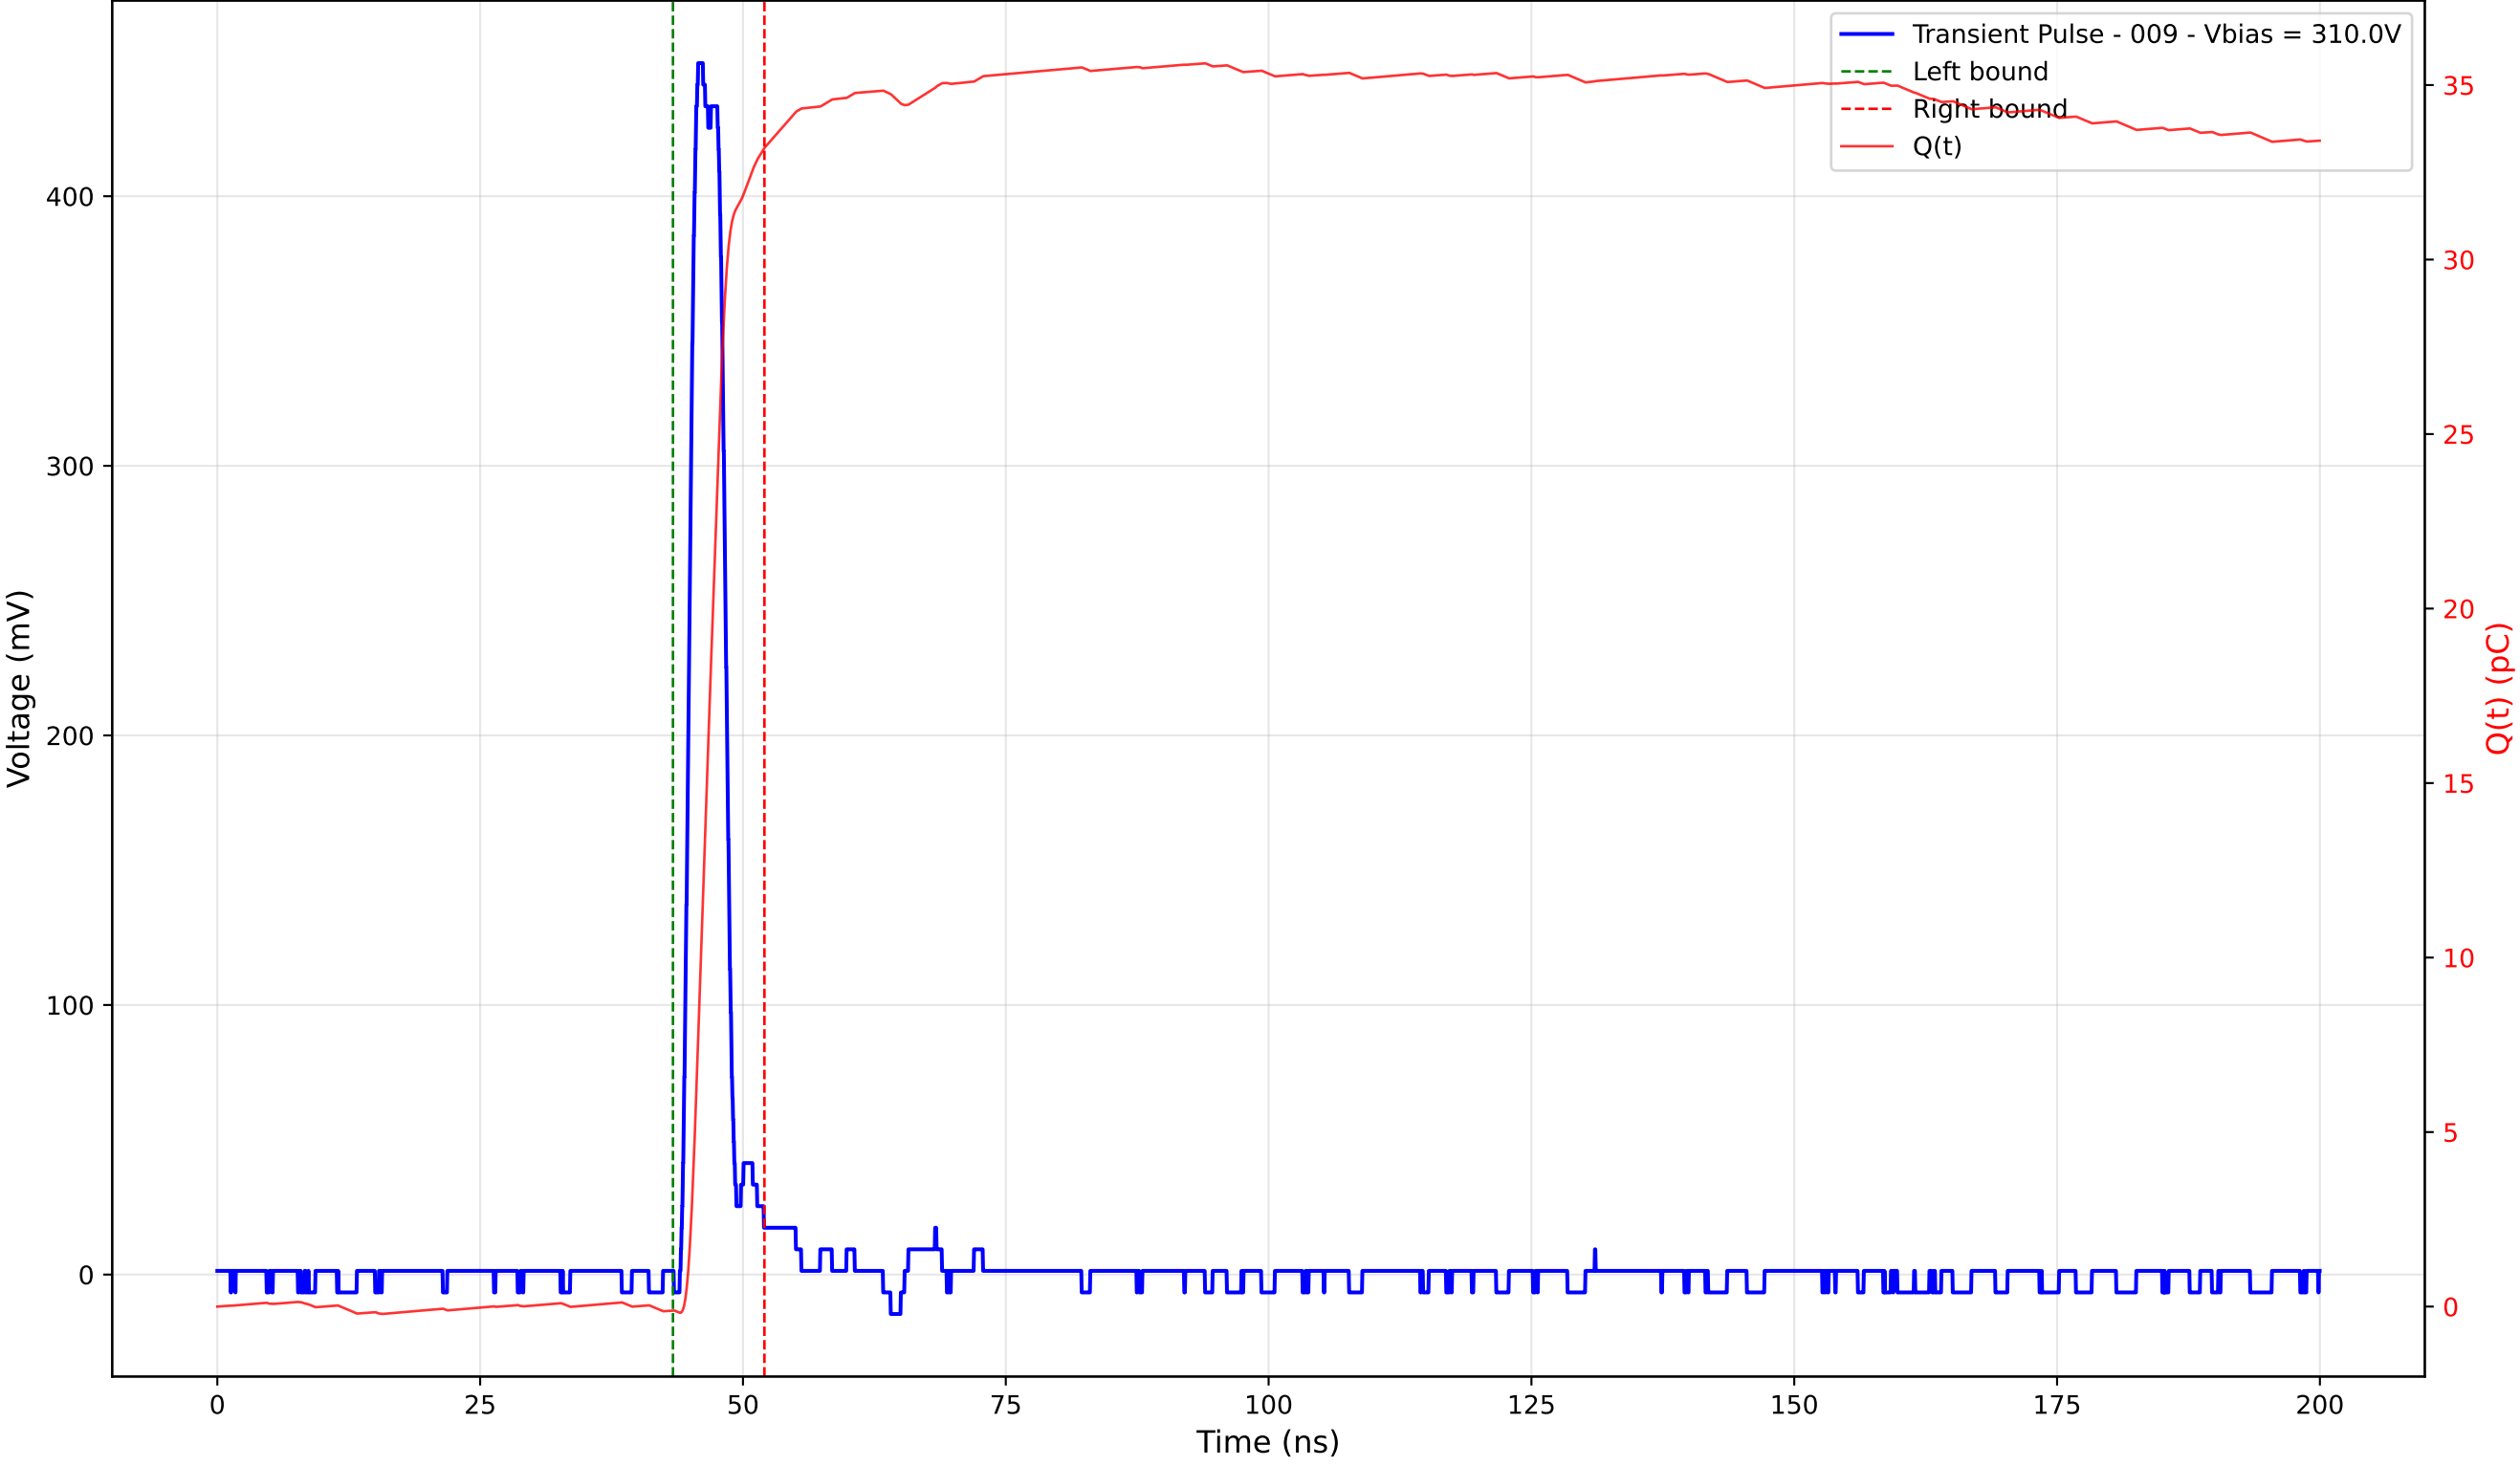


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 33.00 pC - Rise Time: 1.10 ns

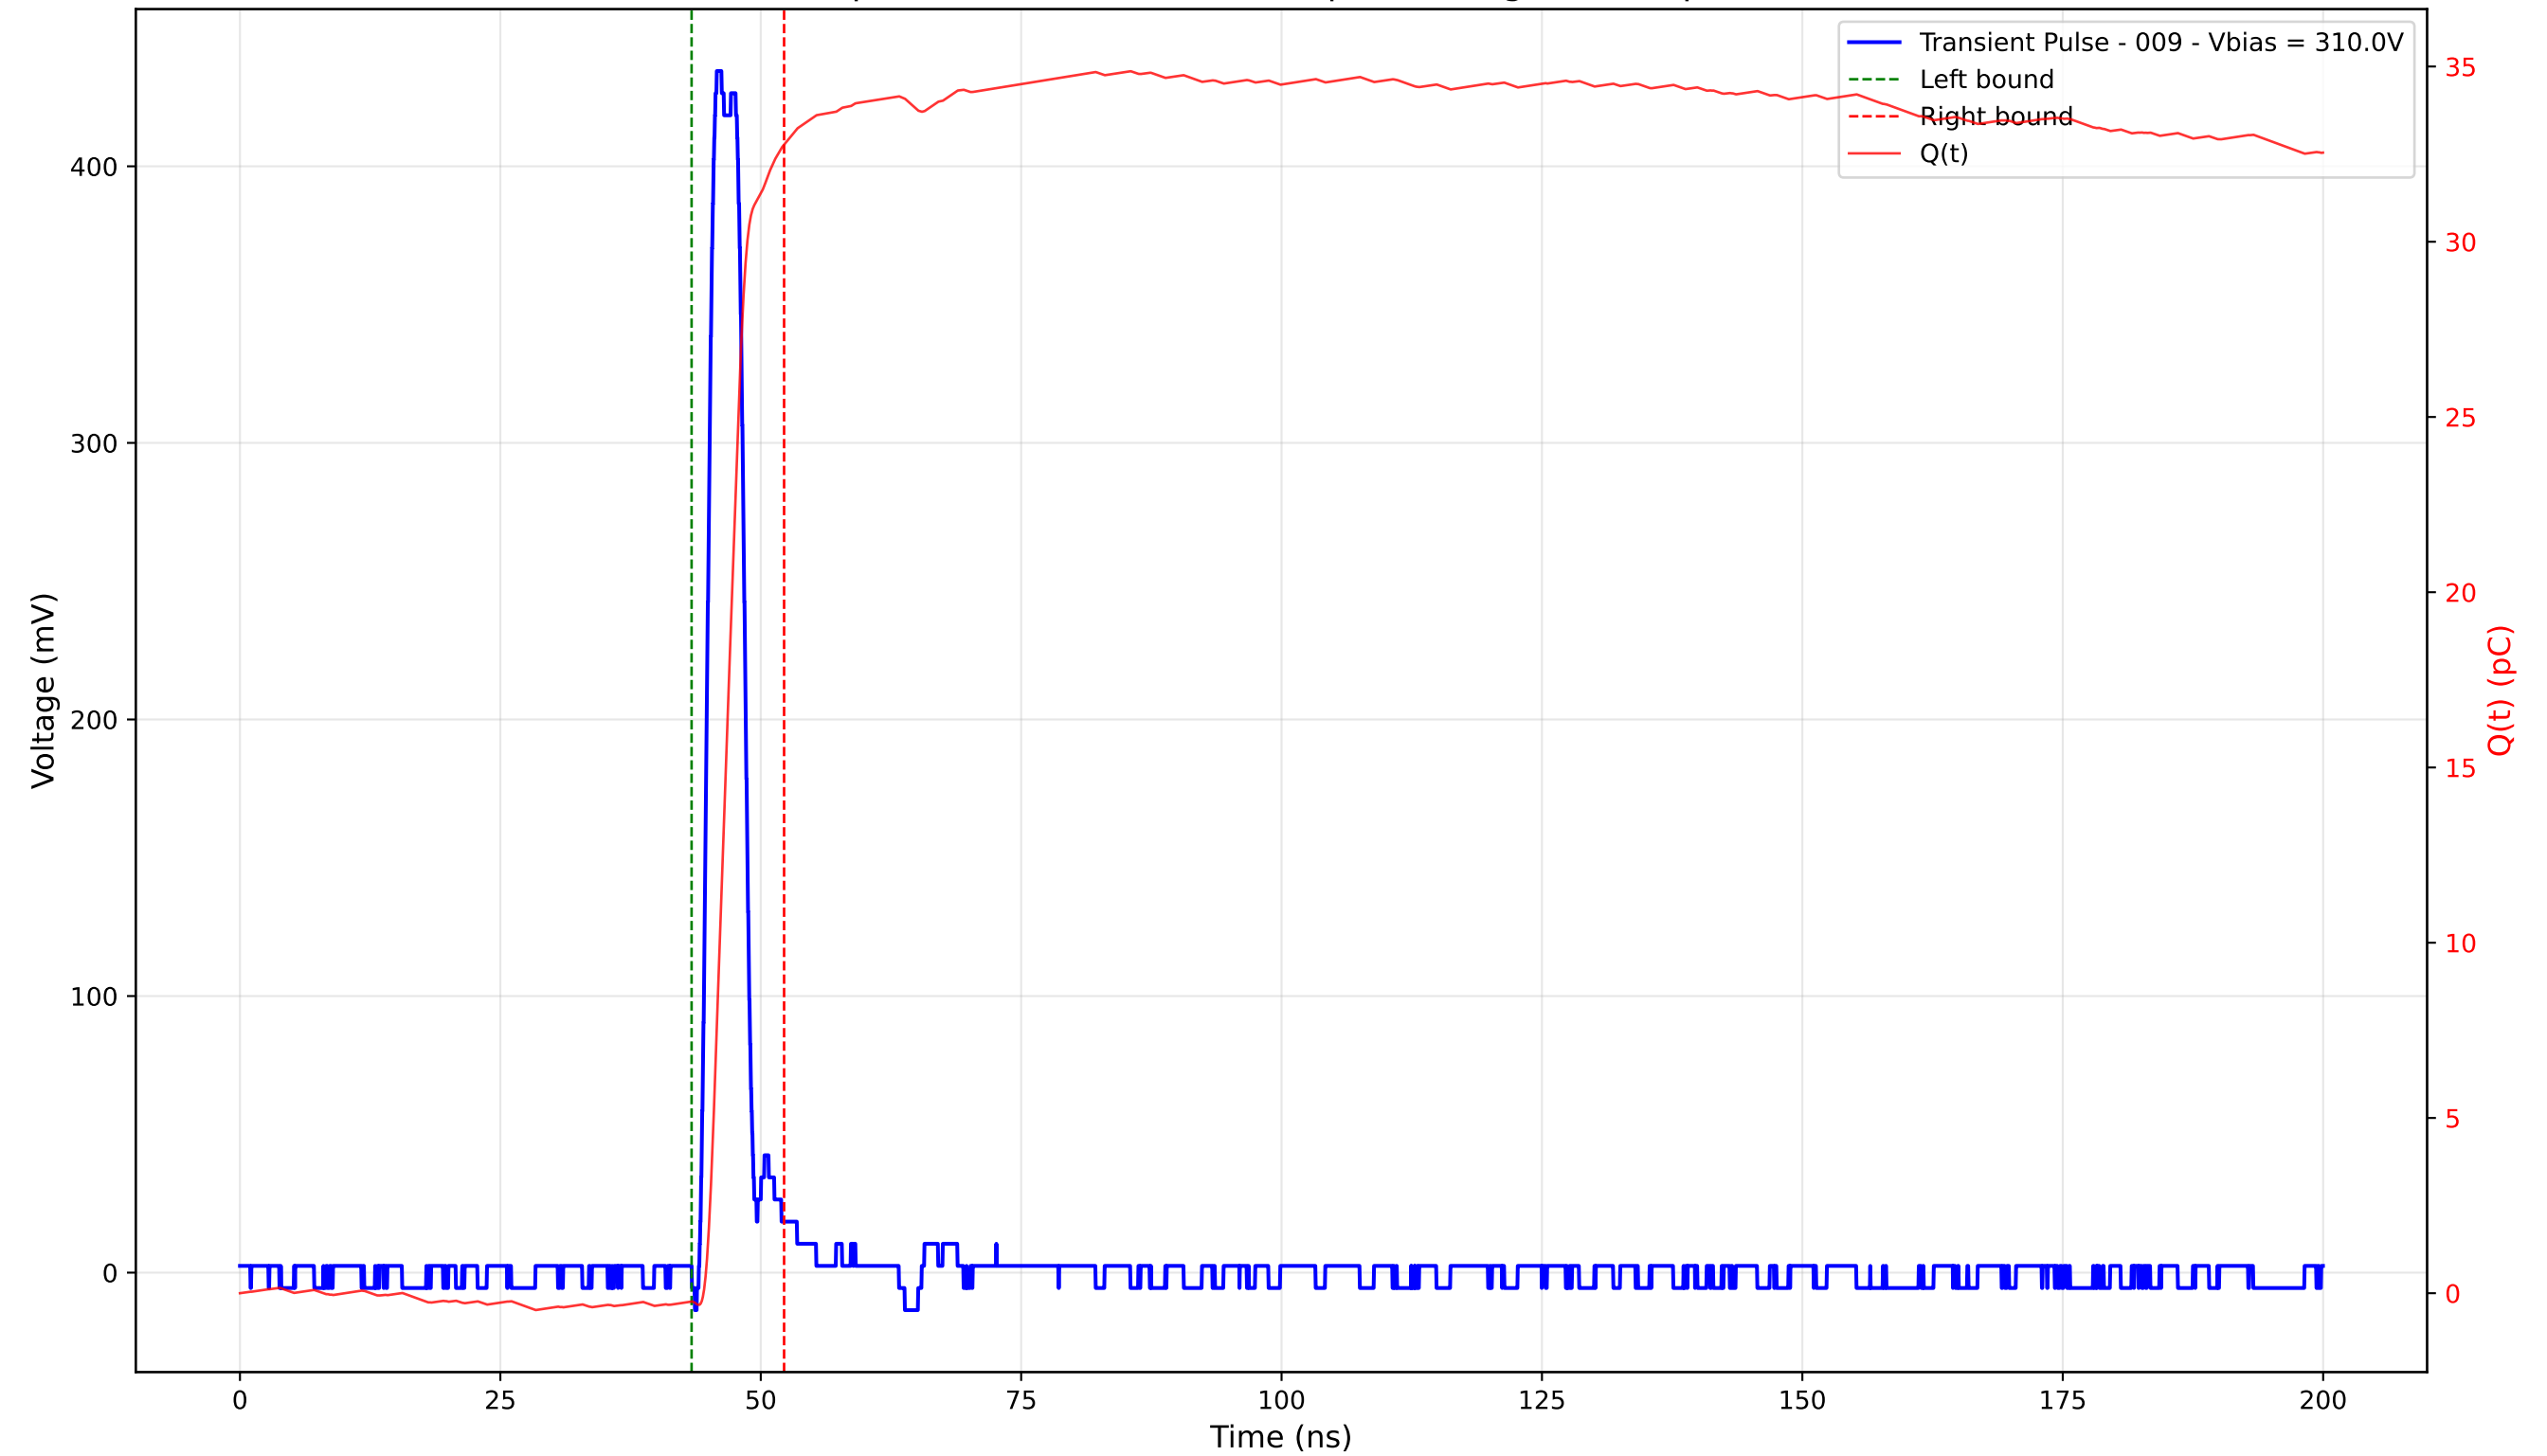


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 33.34 pC - Rise Time: 1.08 ns

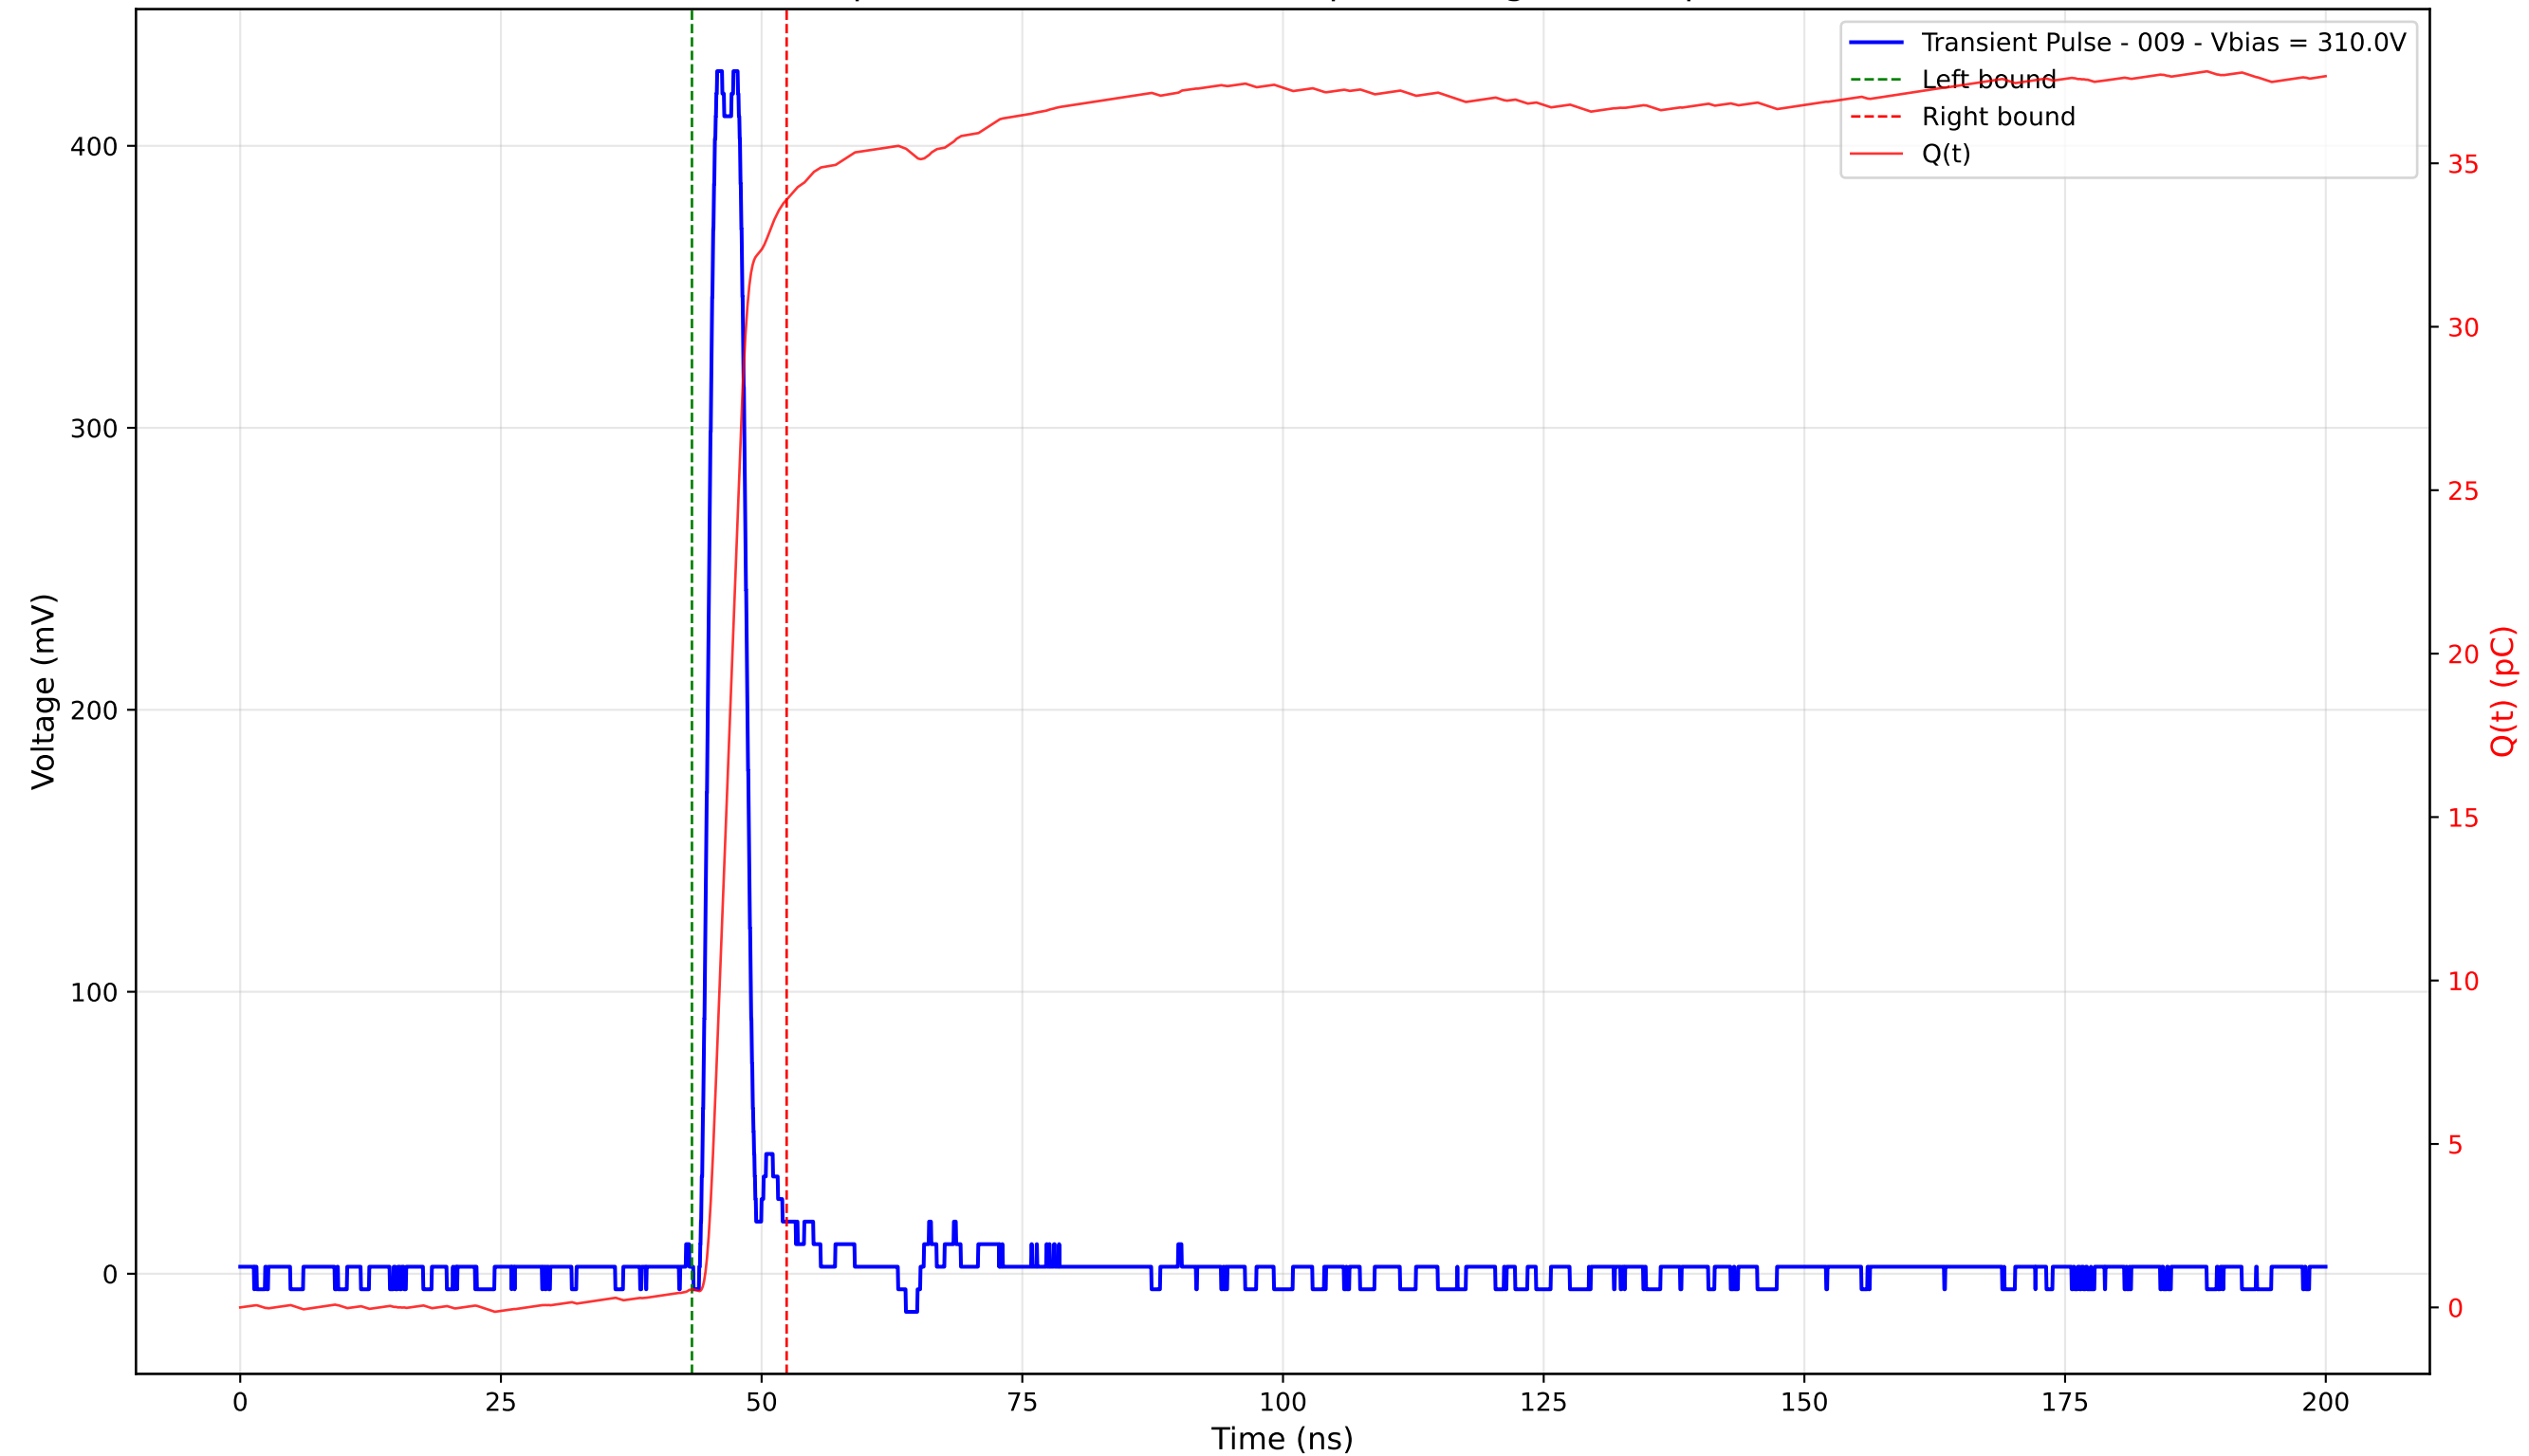


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 33.42 pC - Rise Time: 1.18 ns

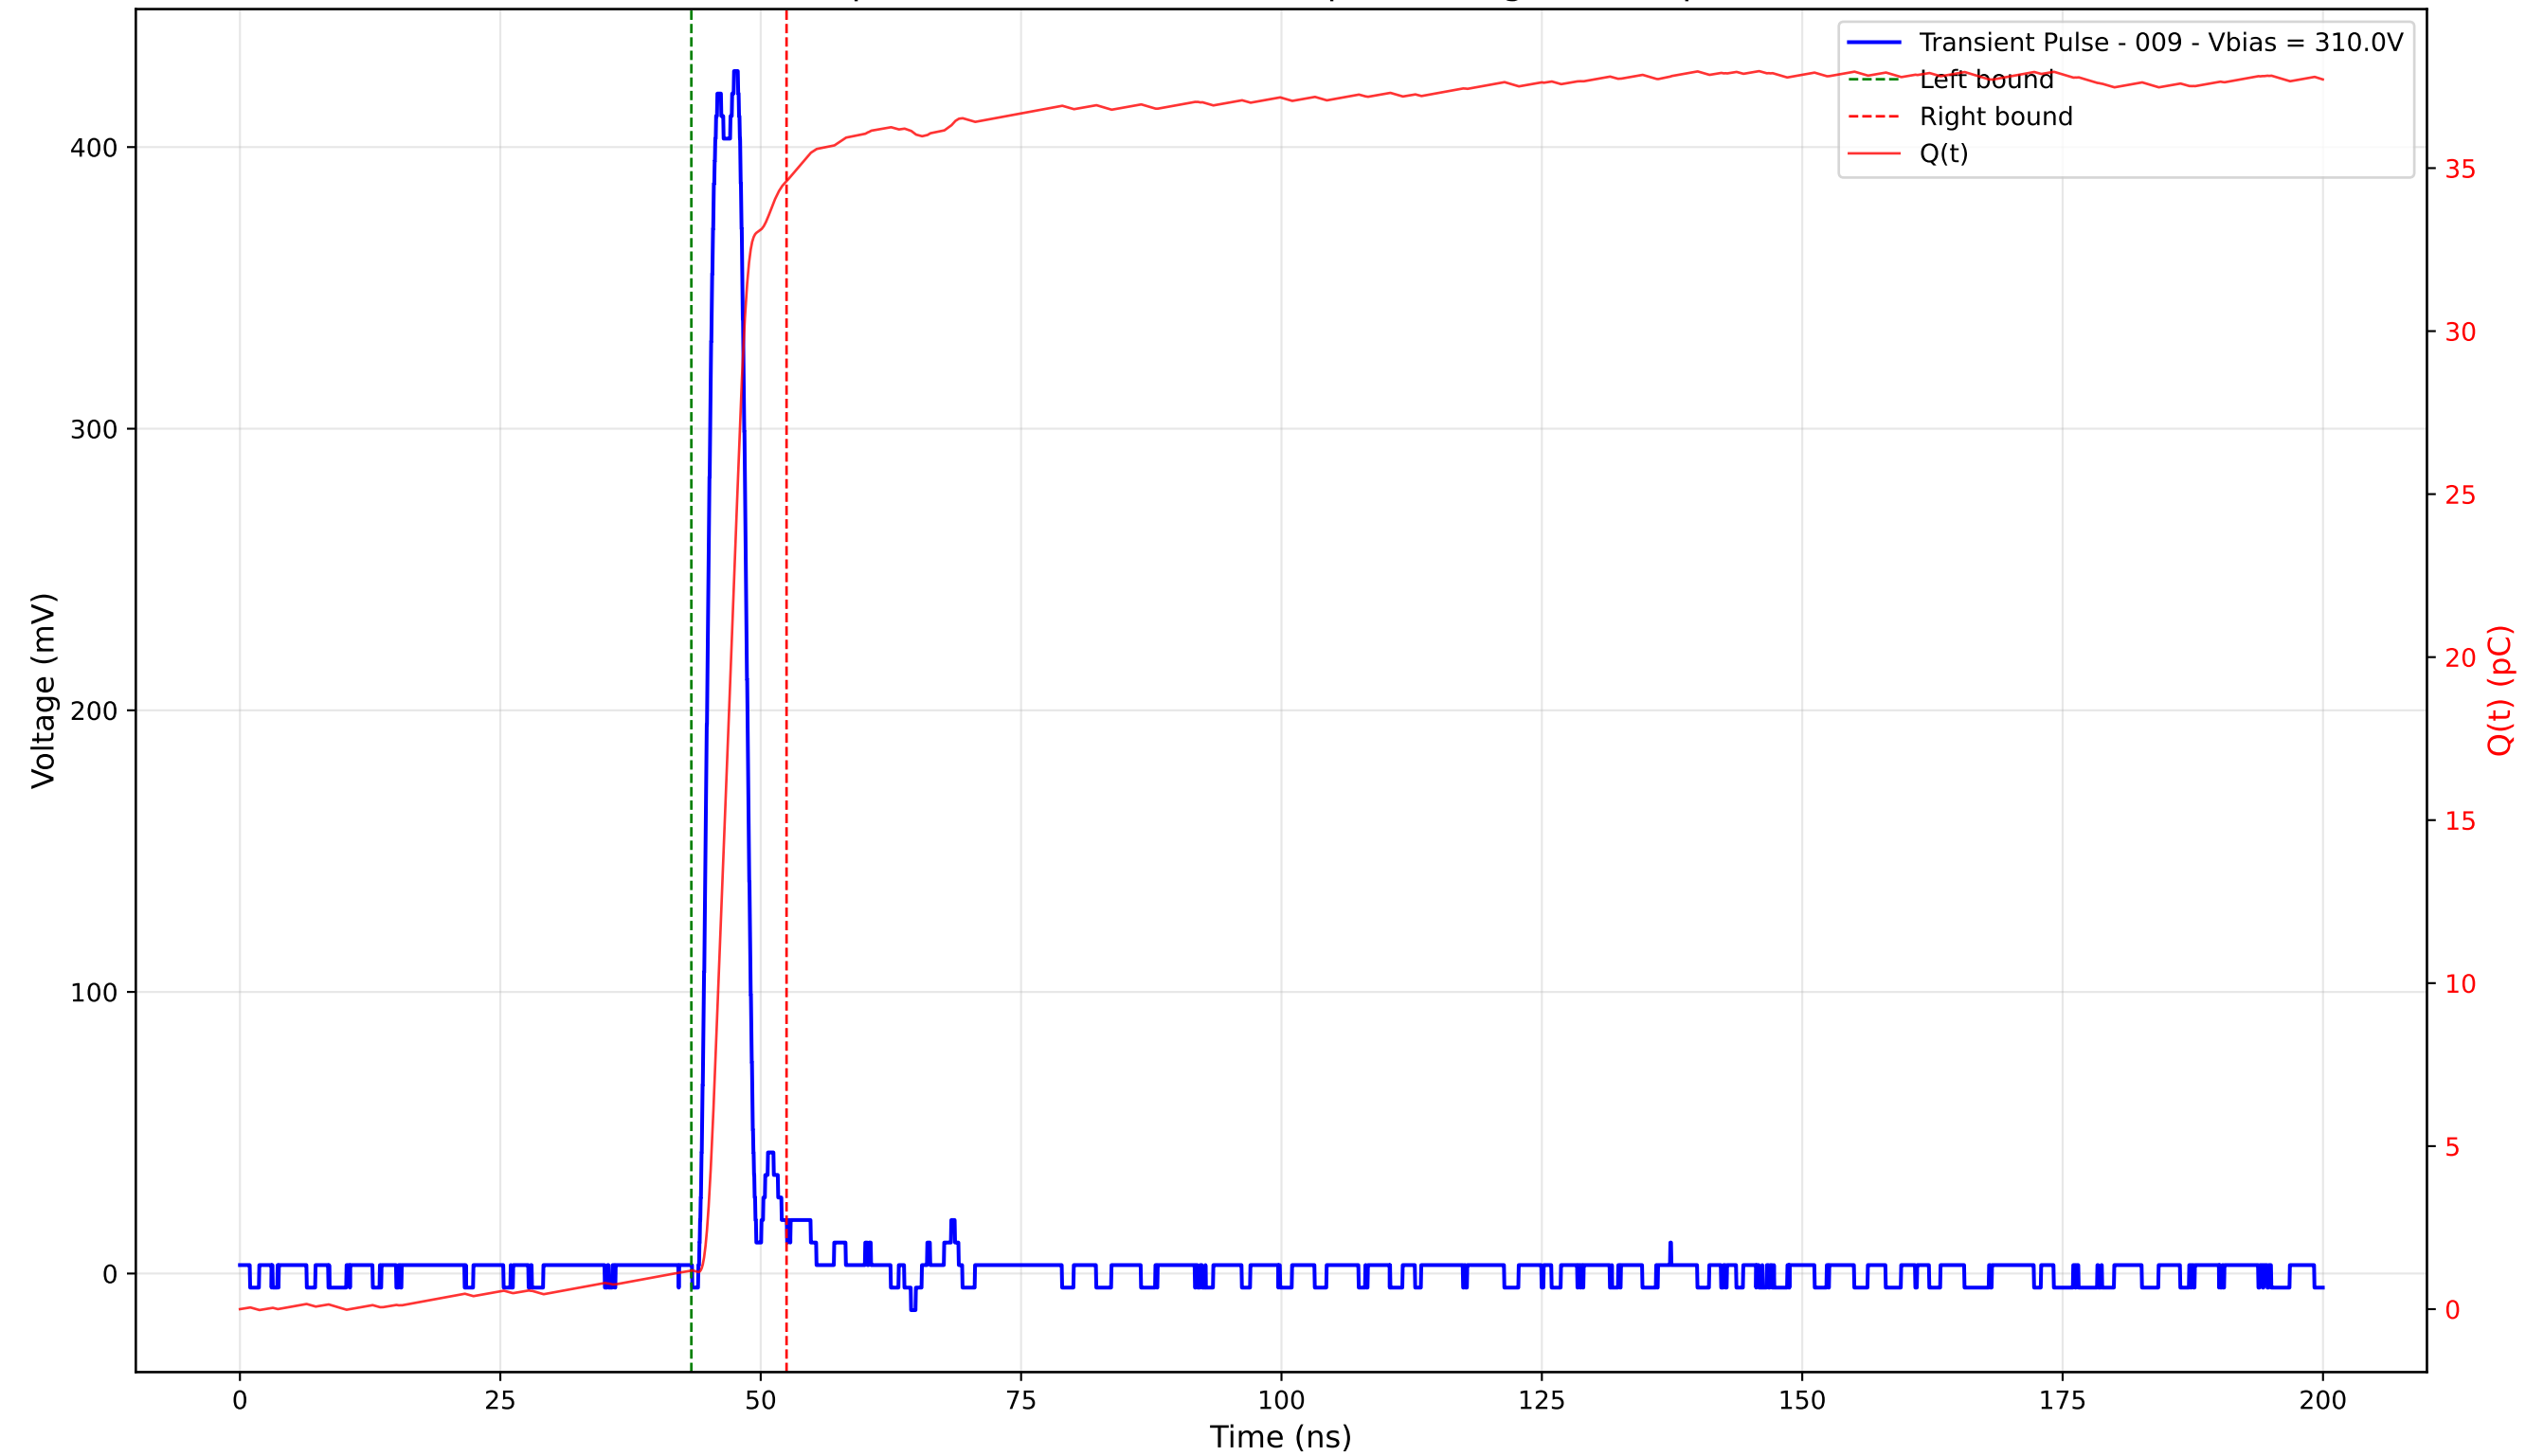


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 32.64 pC - Rise Time: 1.20 ns

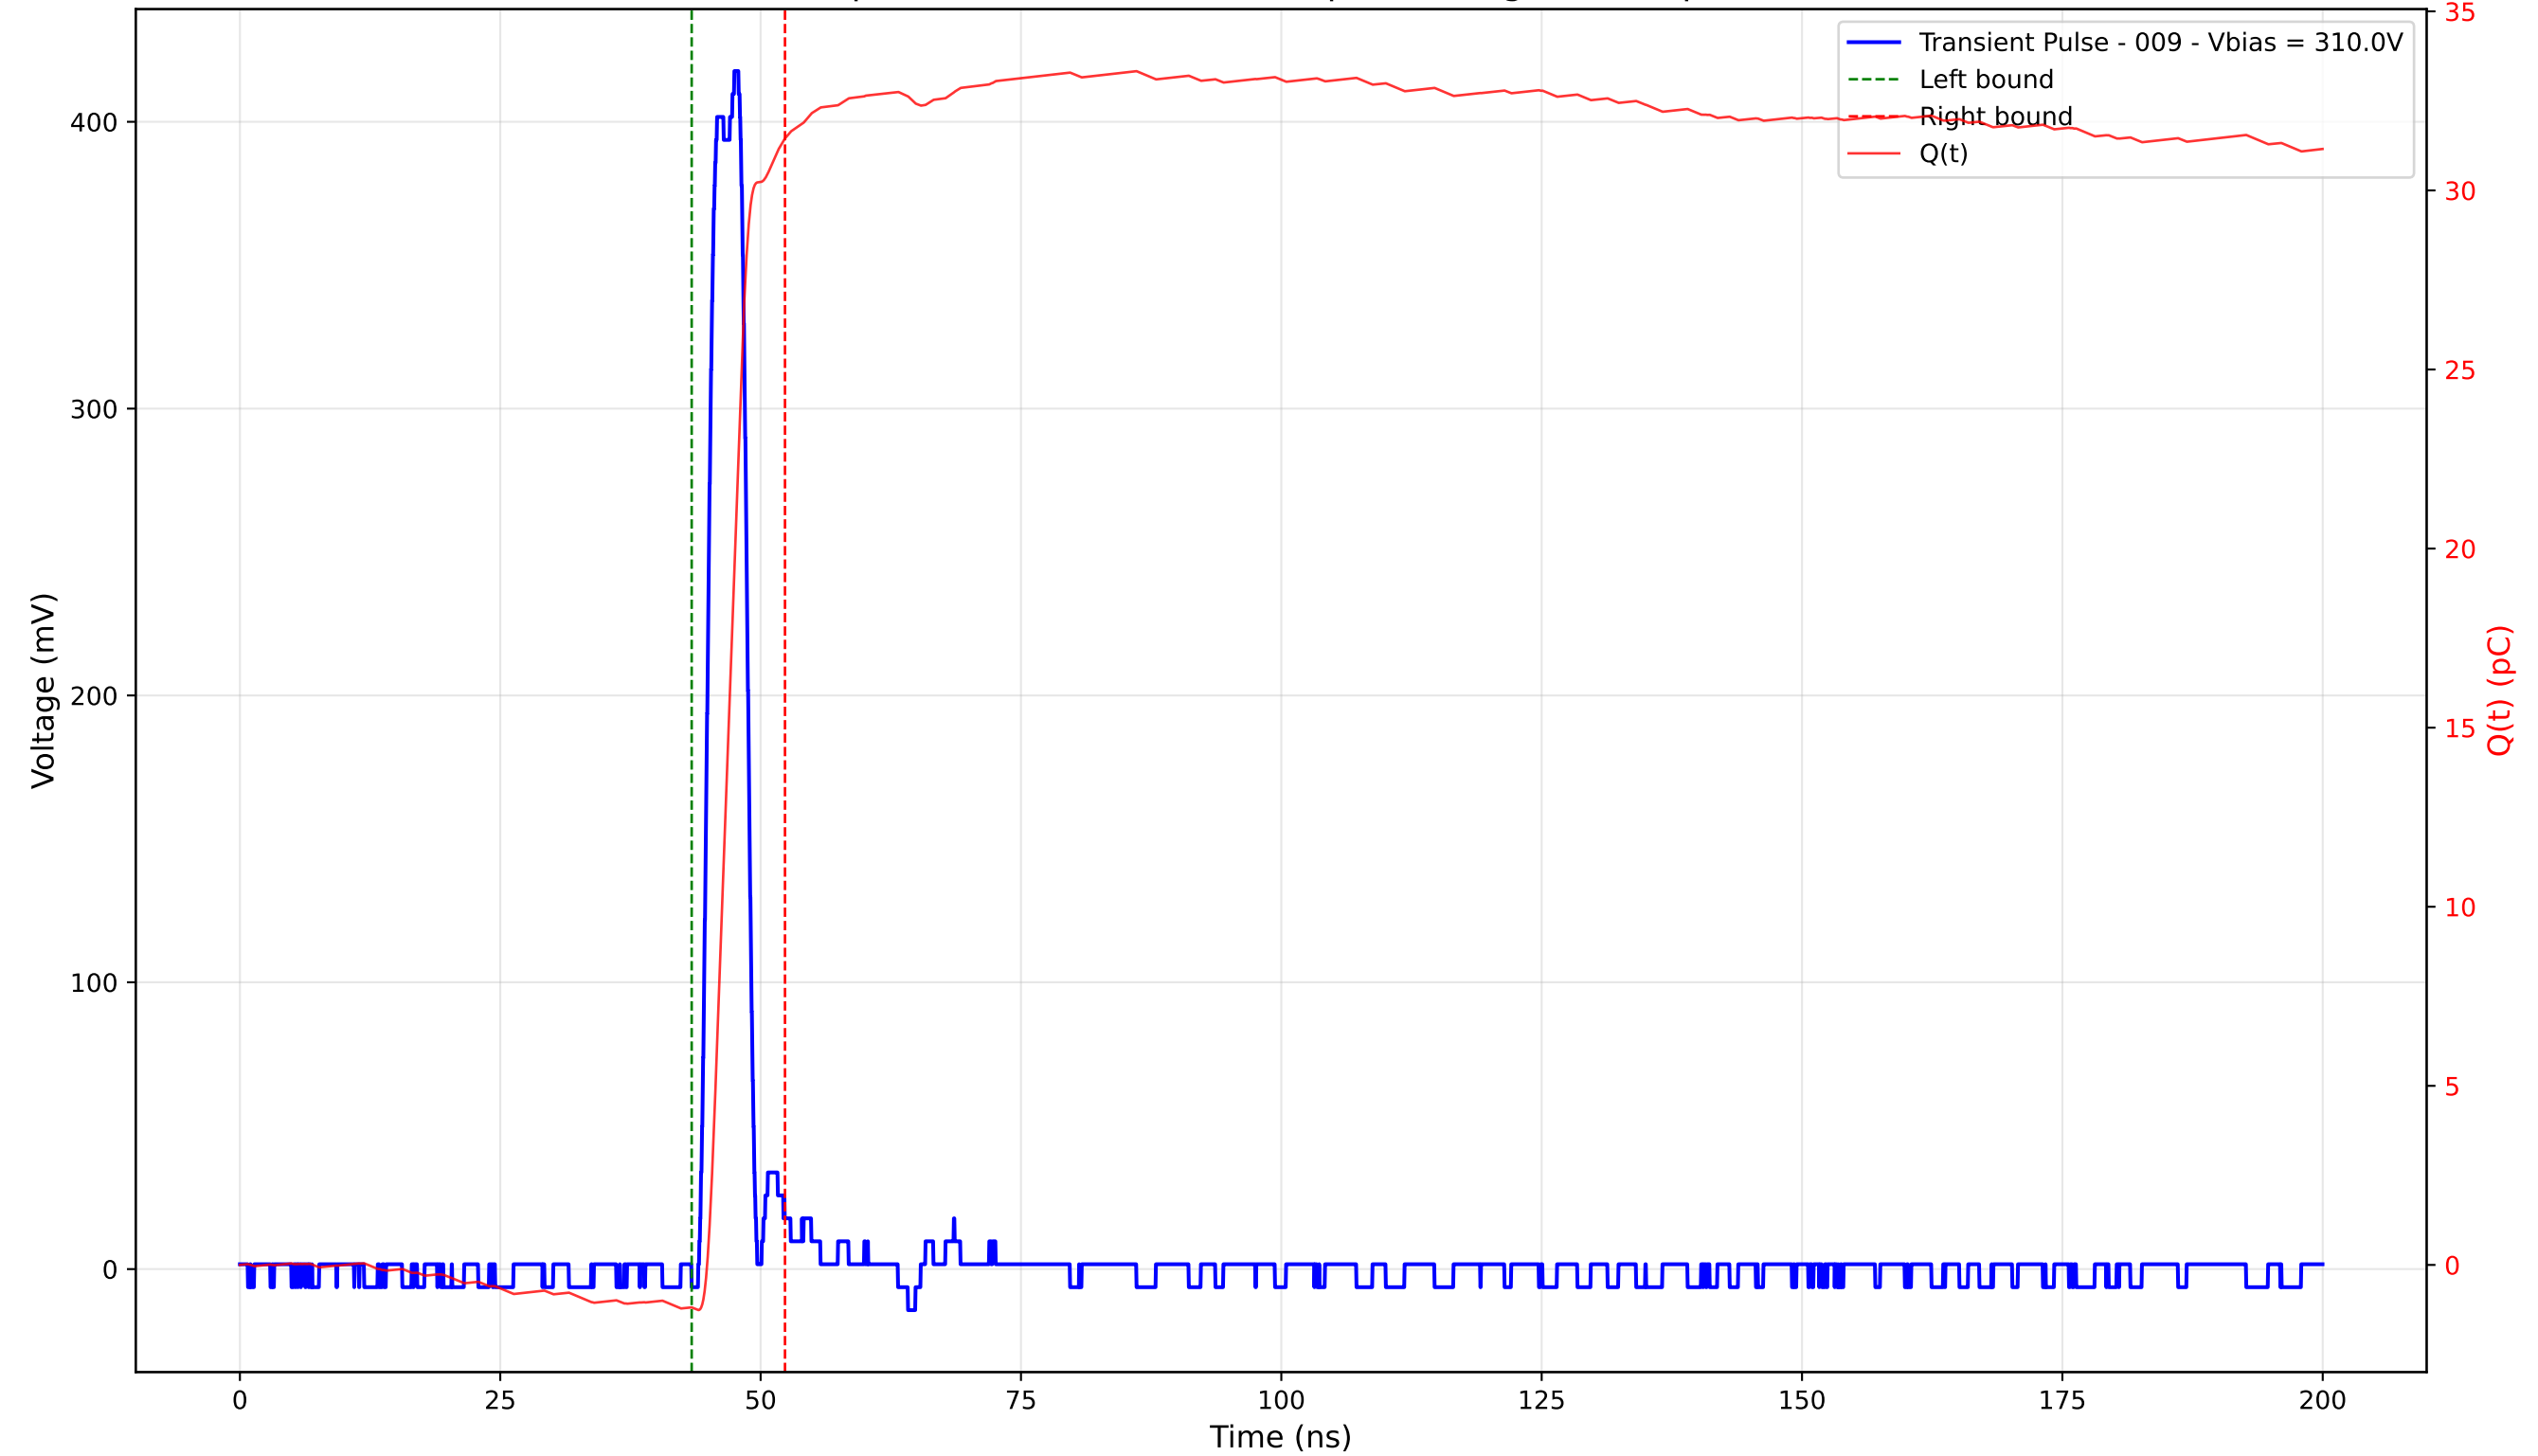


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 32.57 pC - Rise Time: 1.30 ns

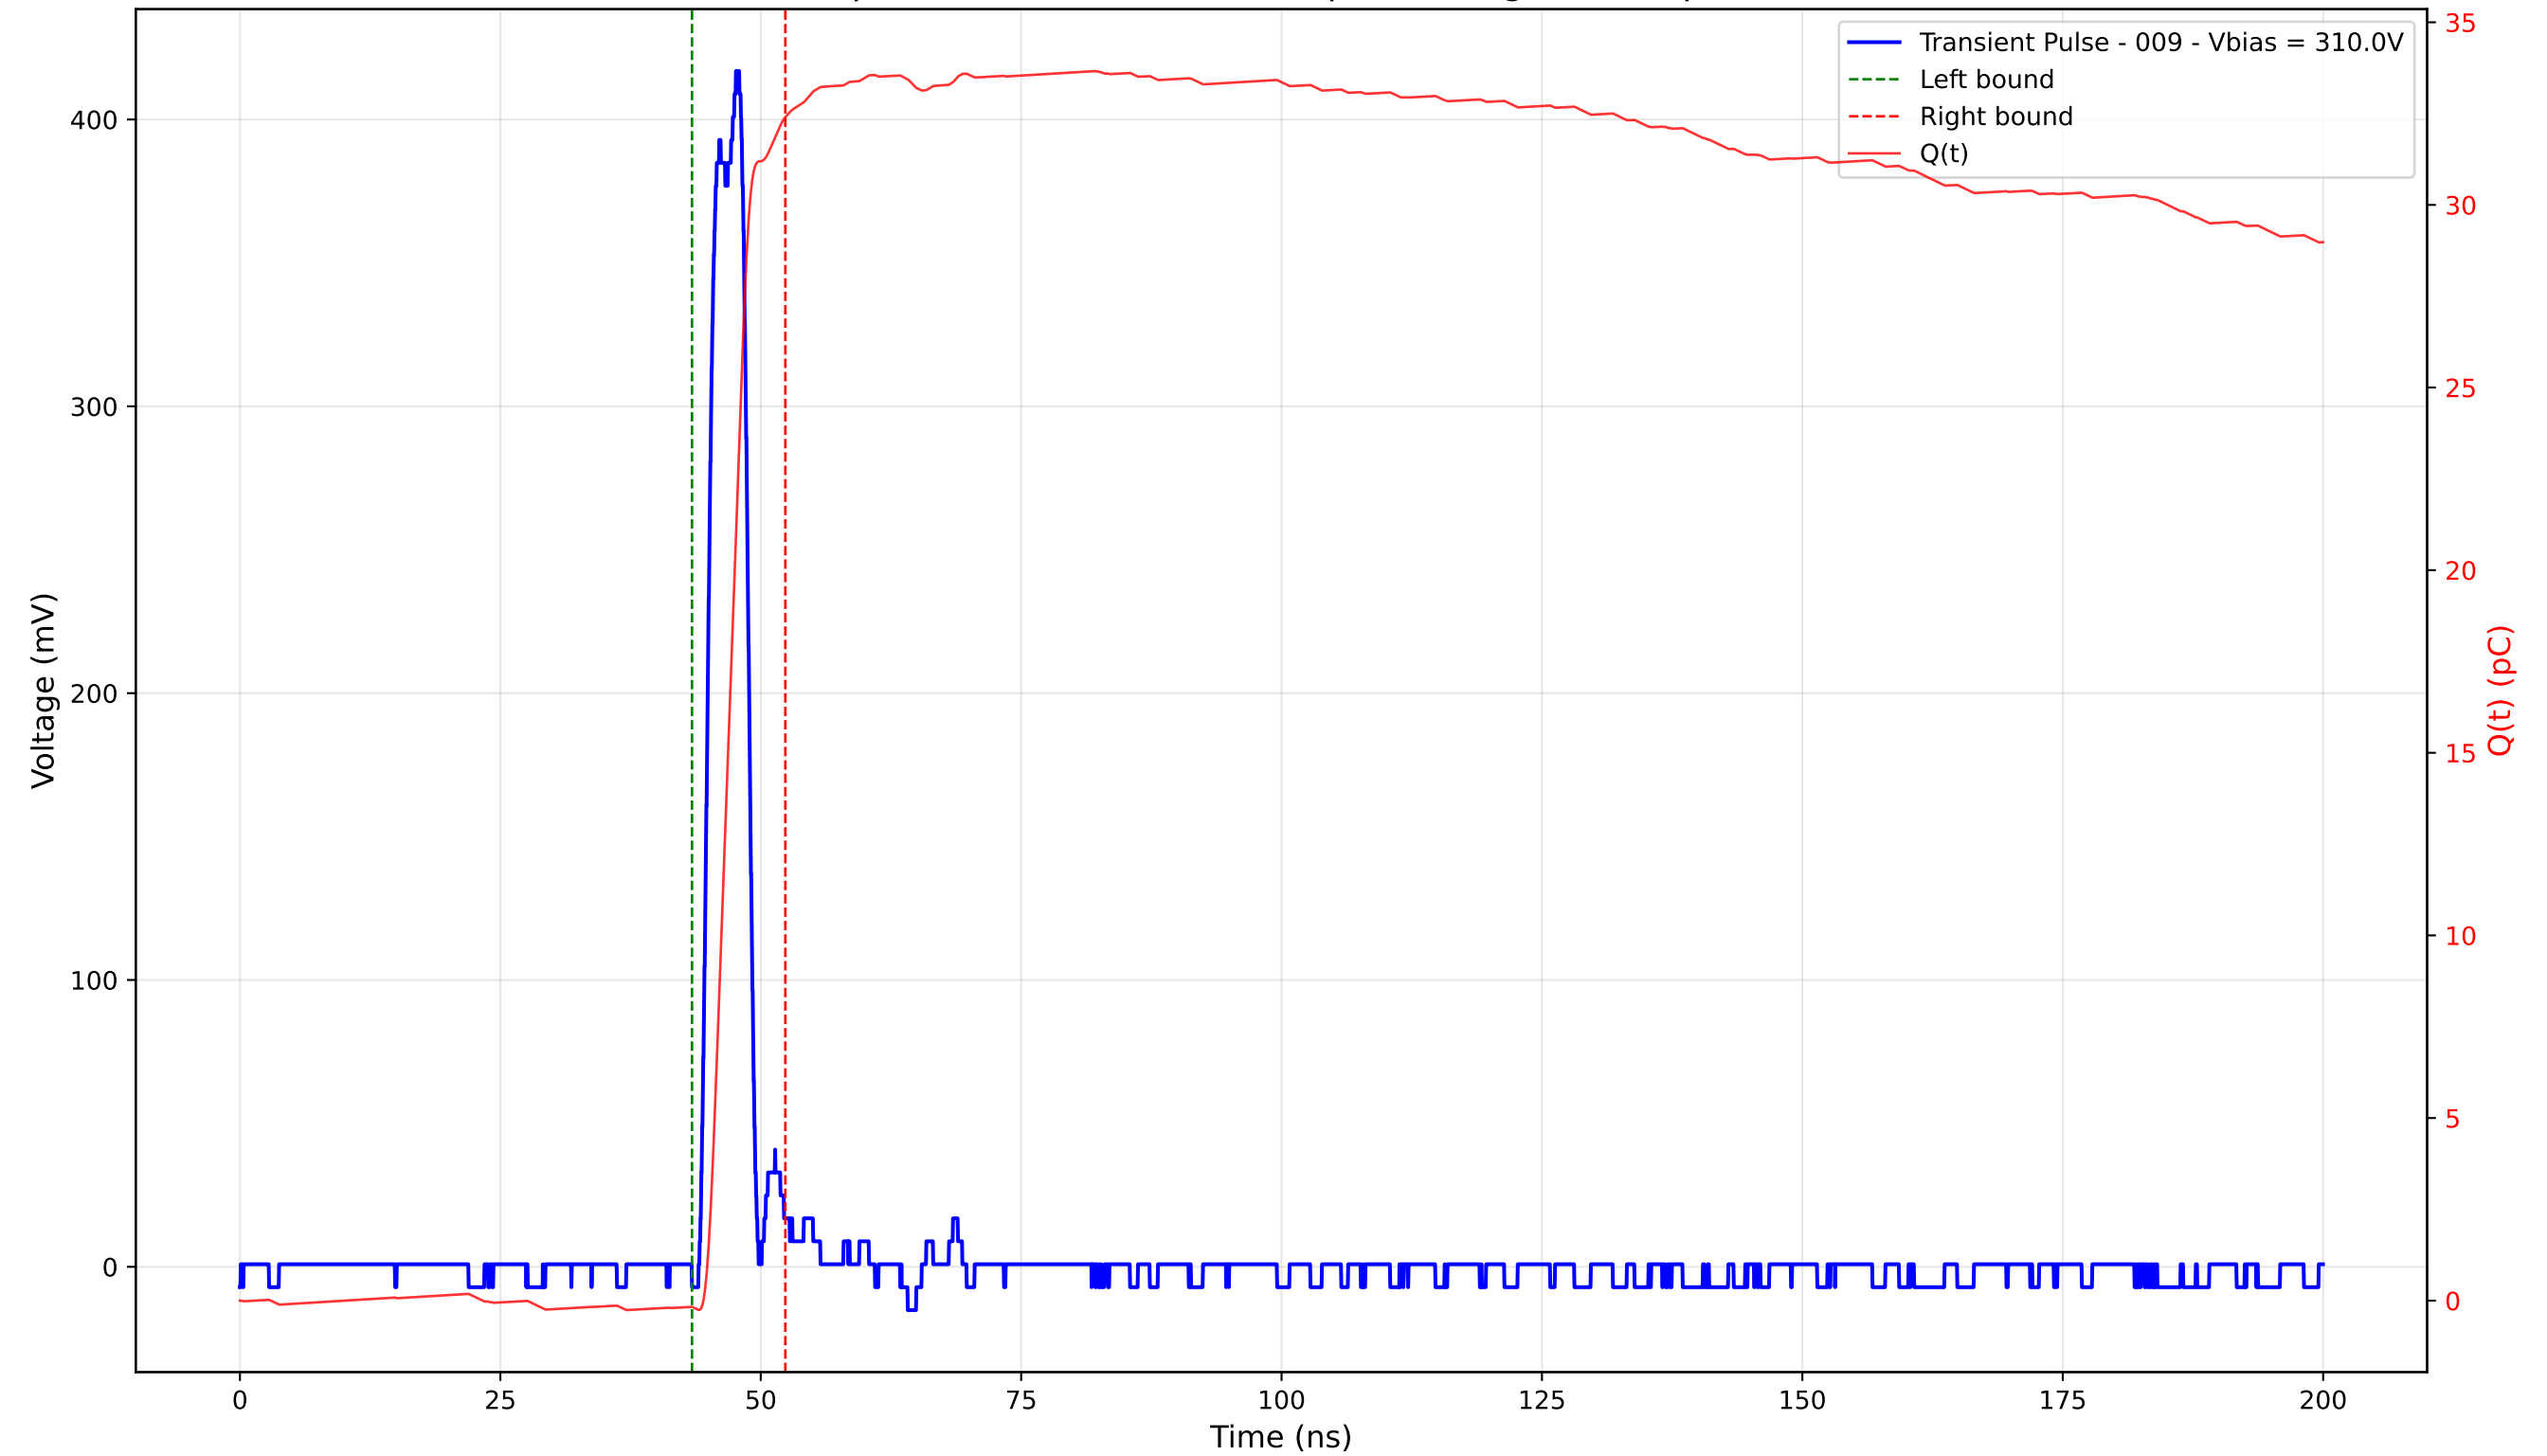


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 32.91 pC - Rise Time: 1.50 ns

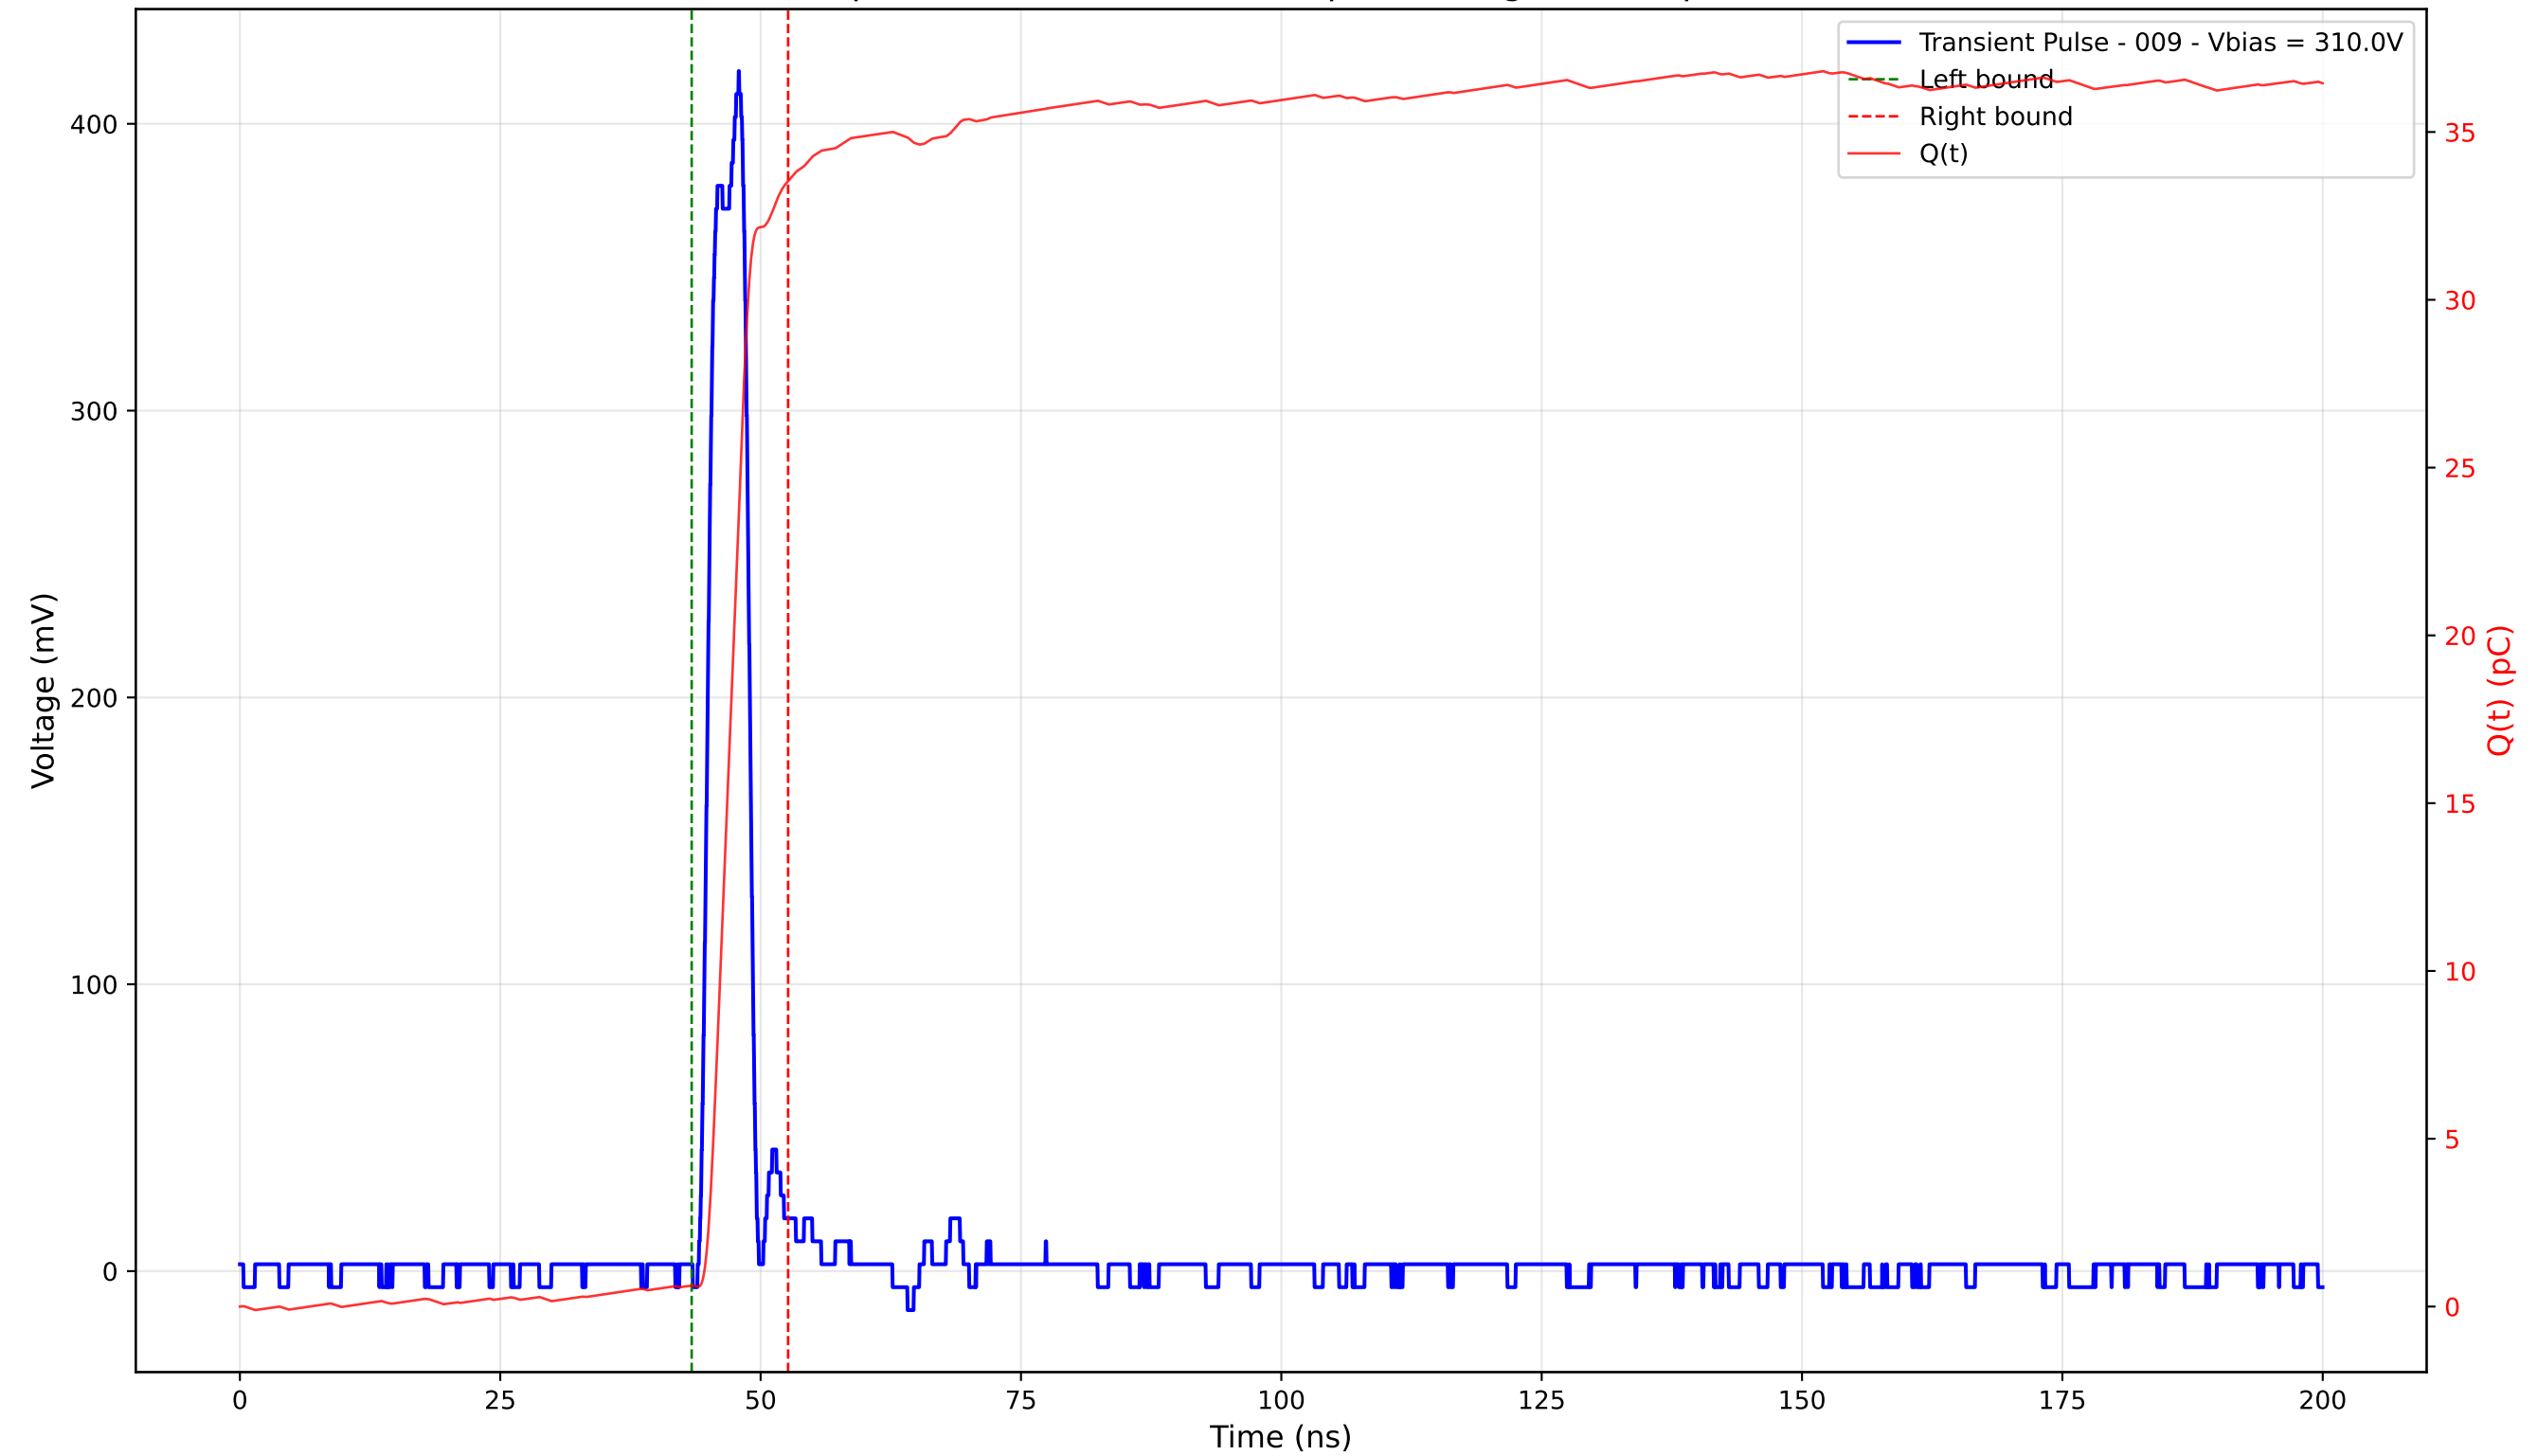


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 31.24 pC - Rise Time: 1.50 ns

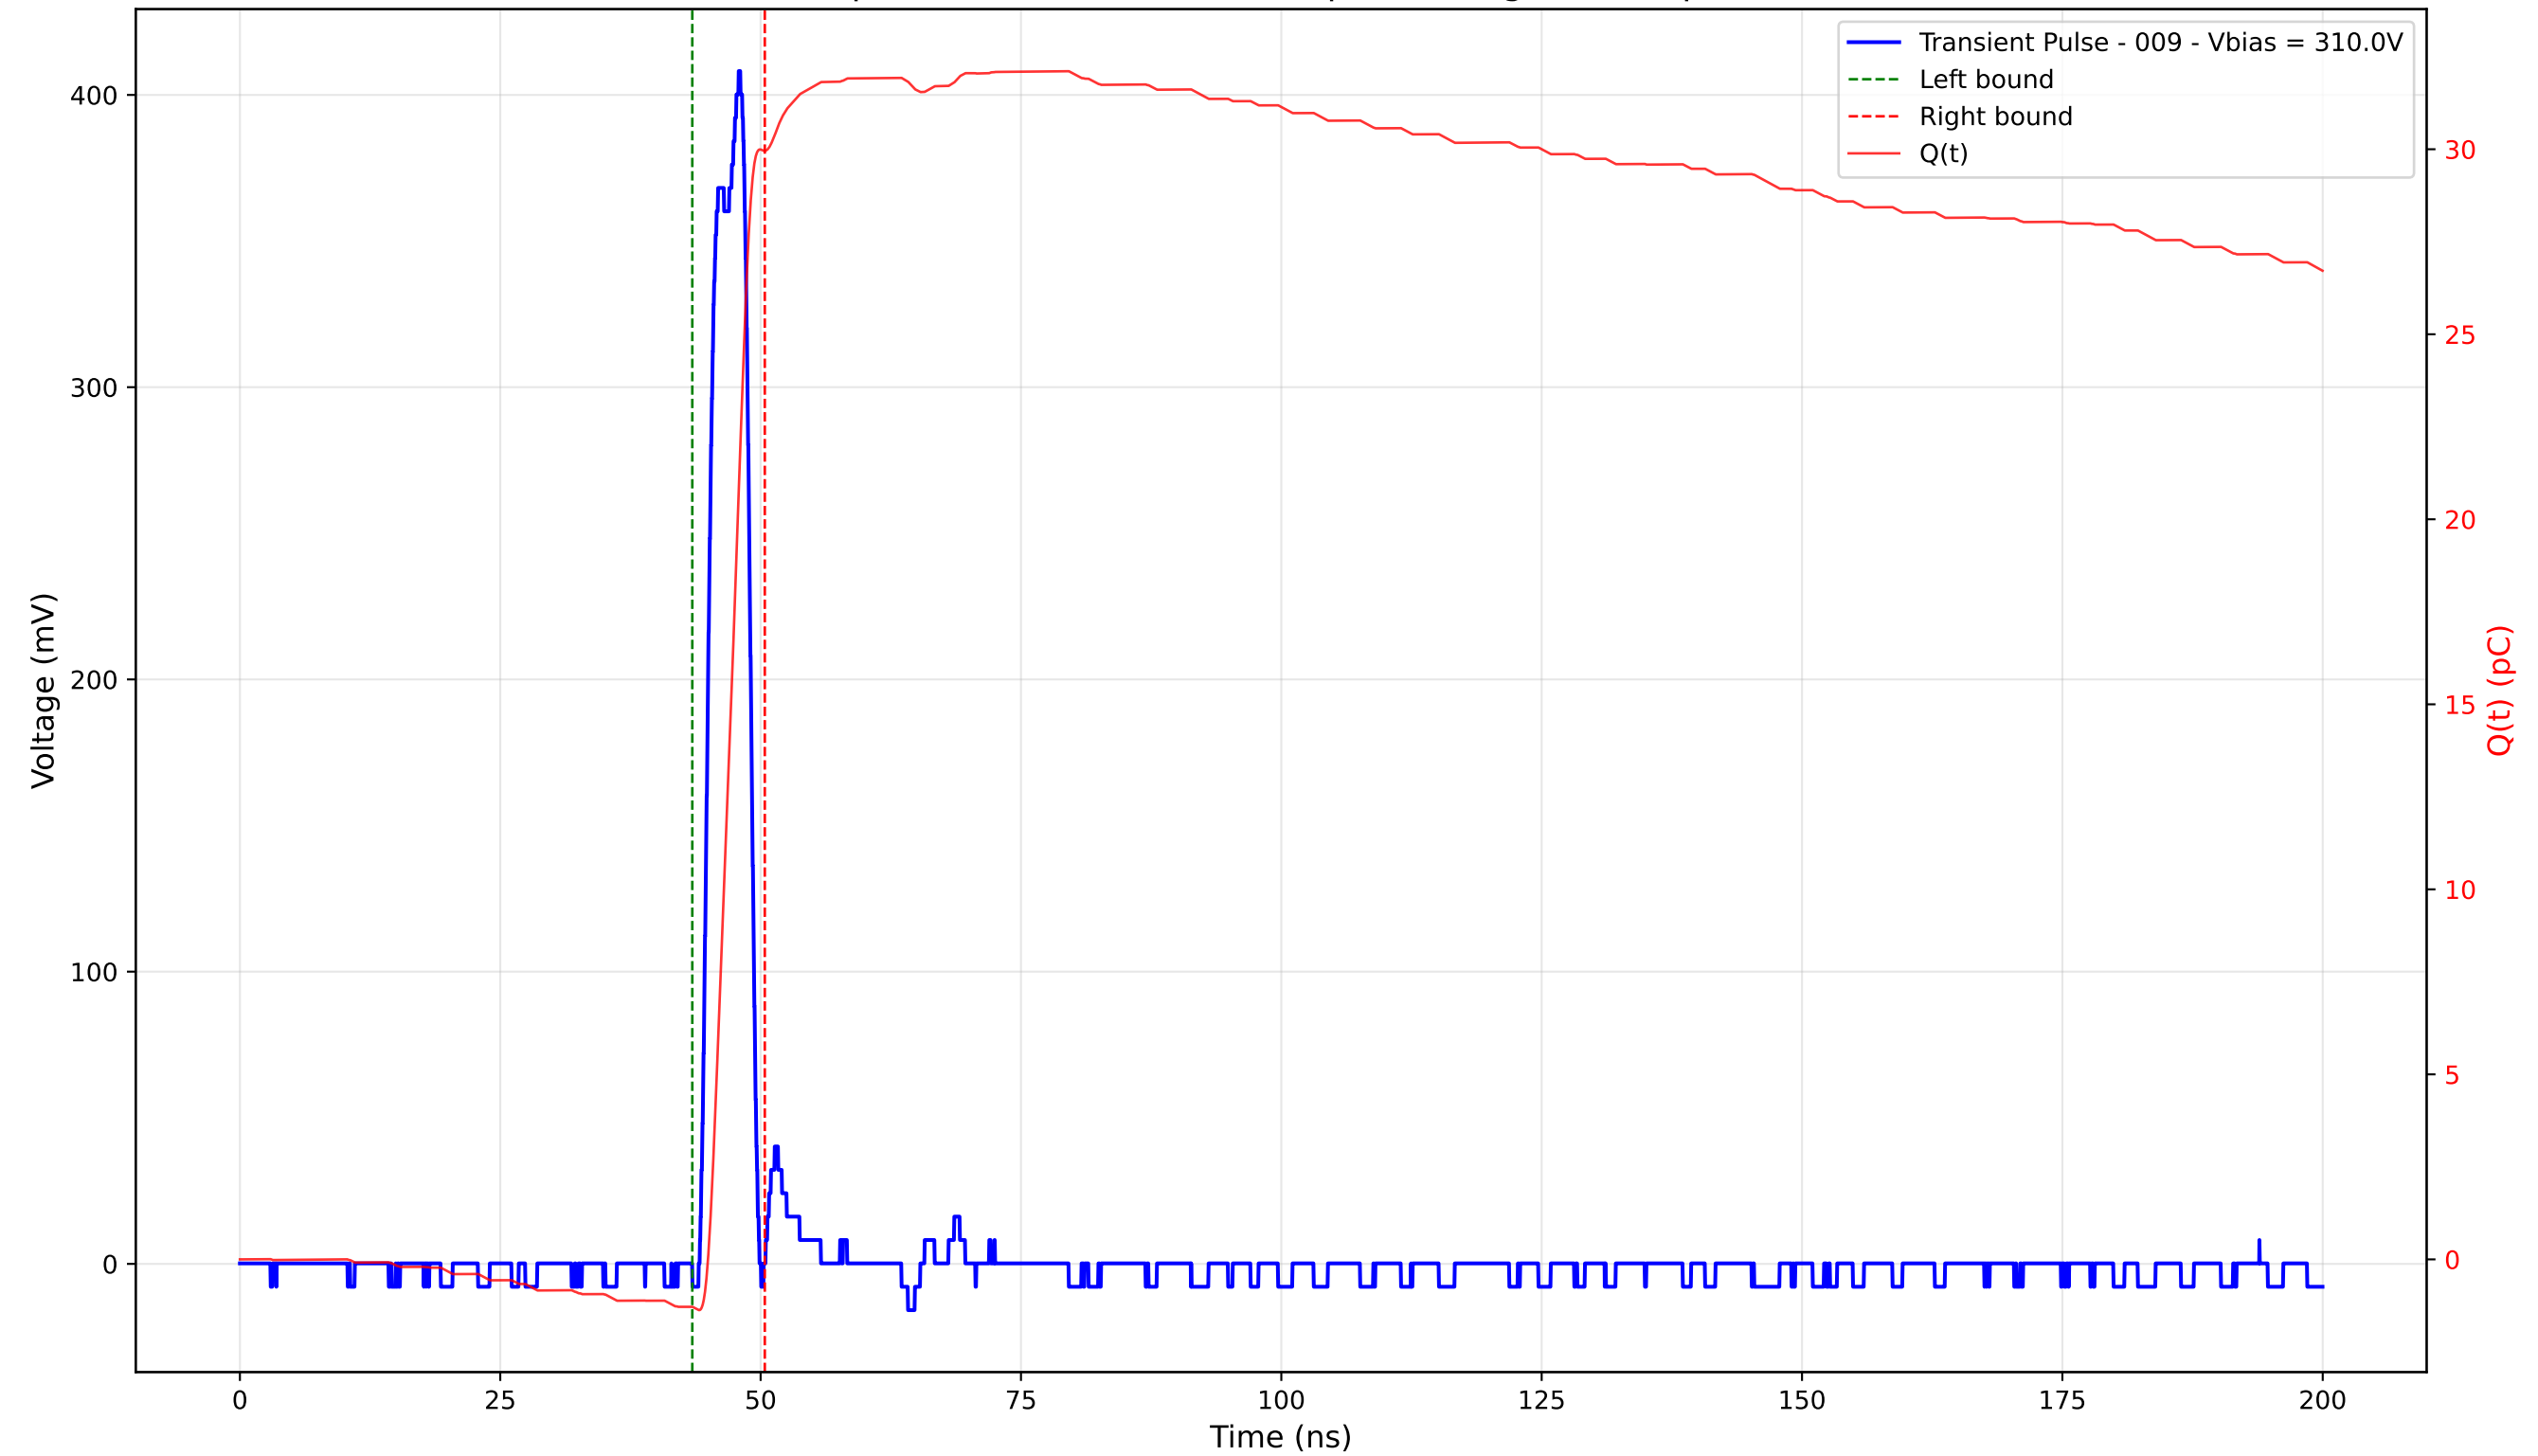


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 32.34 pC - Rise Time: 2.80 ns

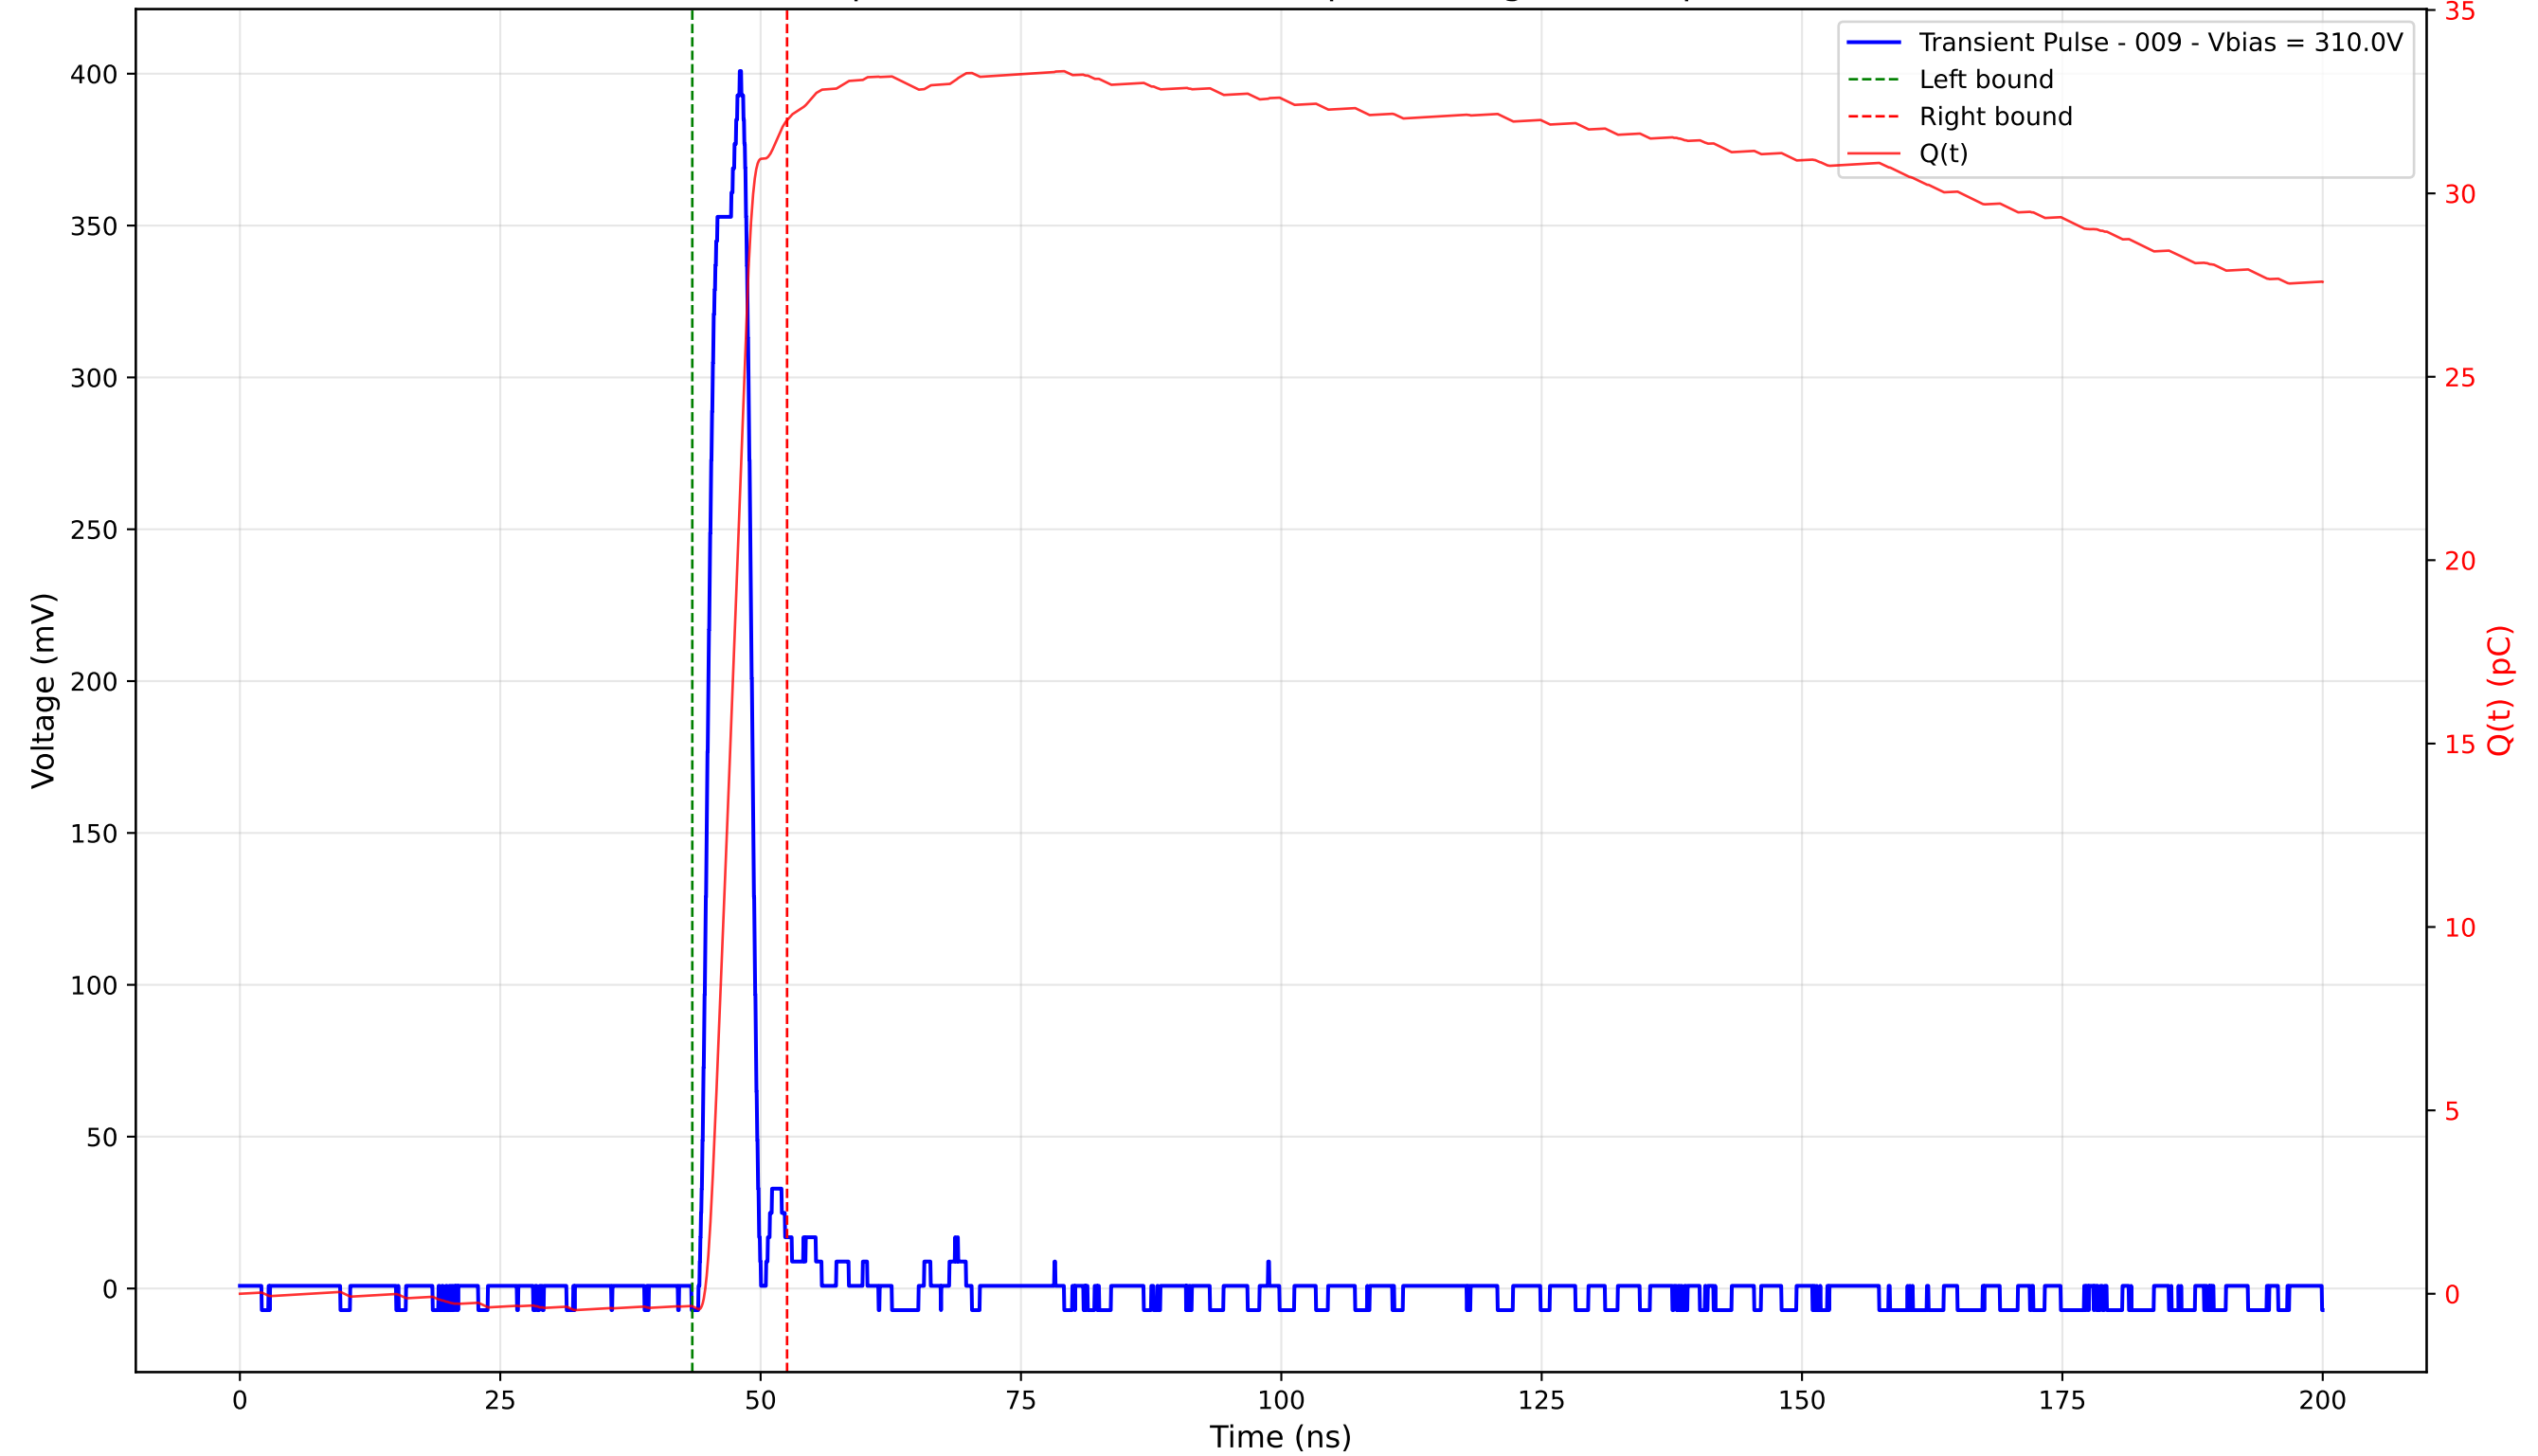


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 32.84 pC - Rise Time: 2.95 ns

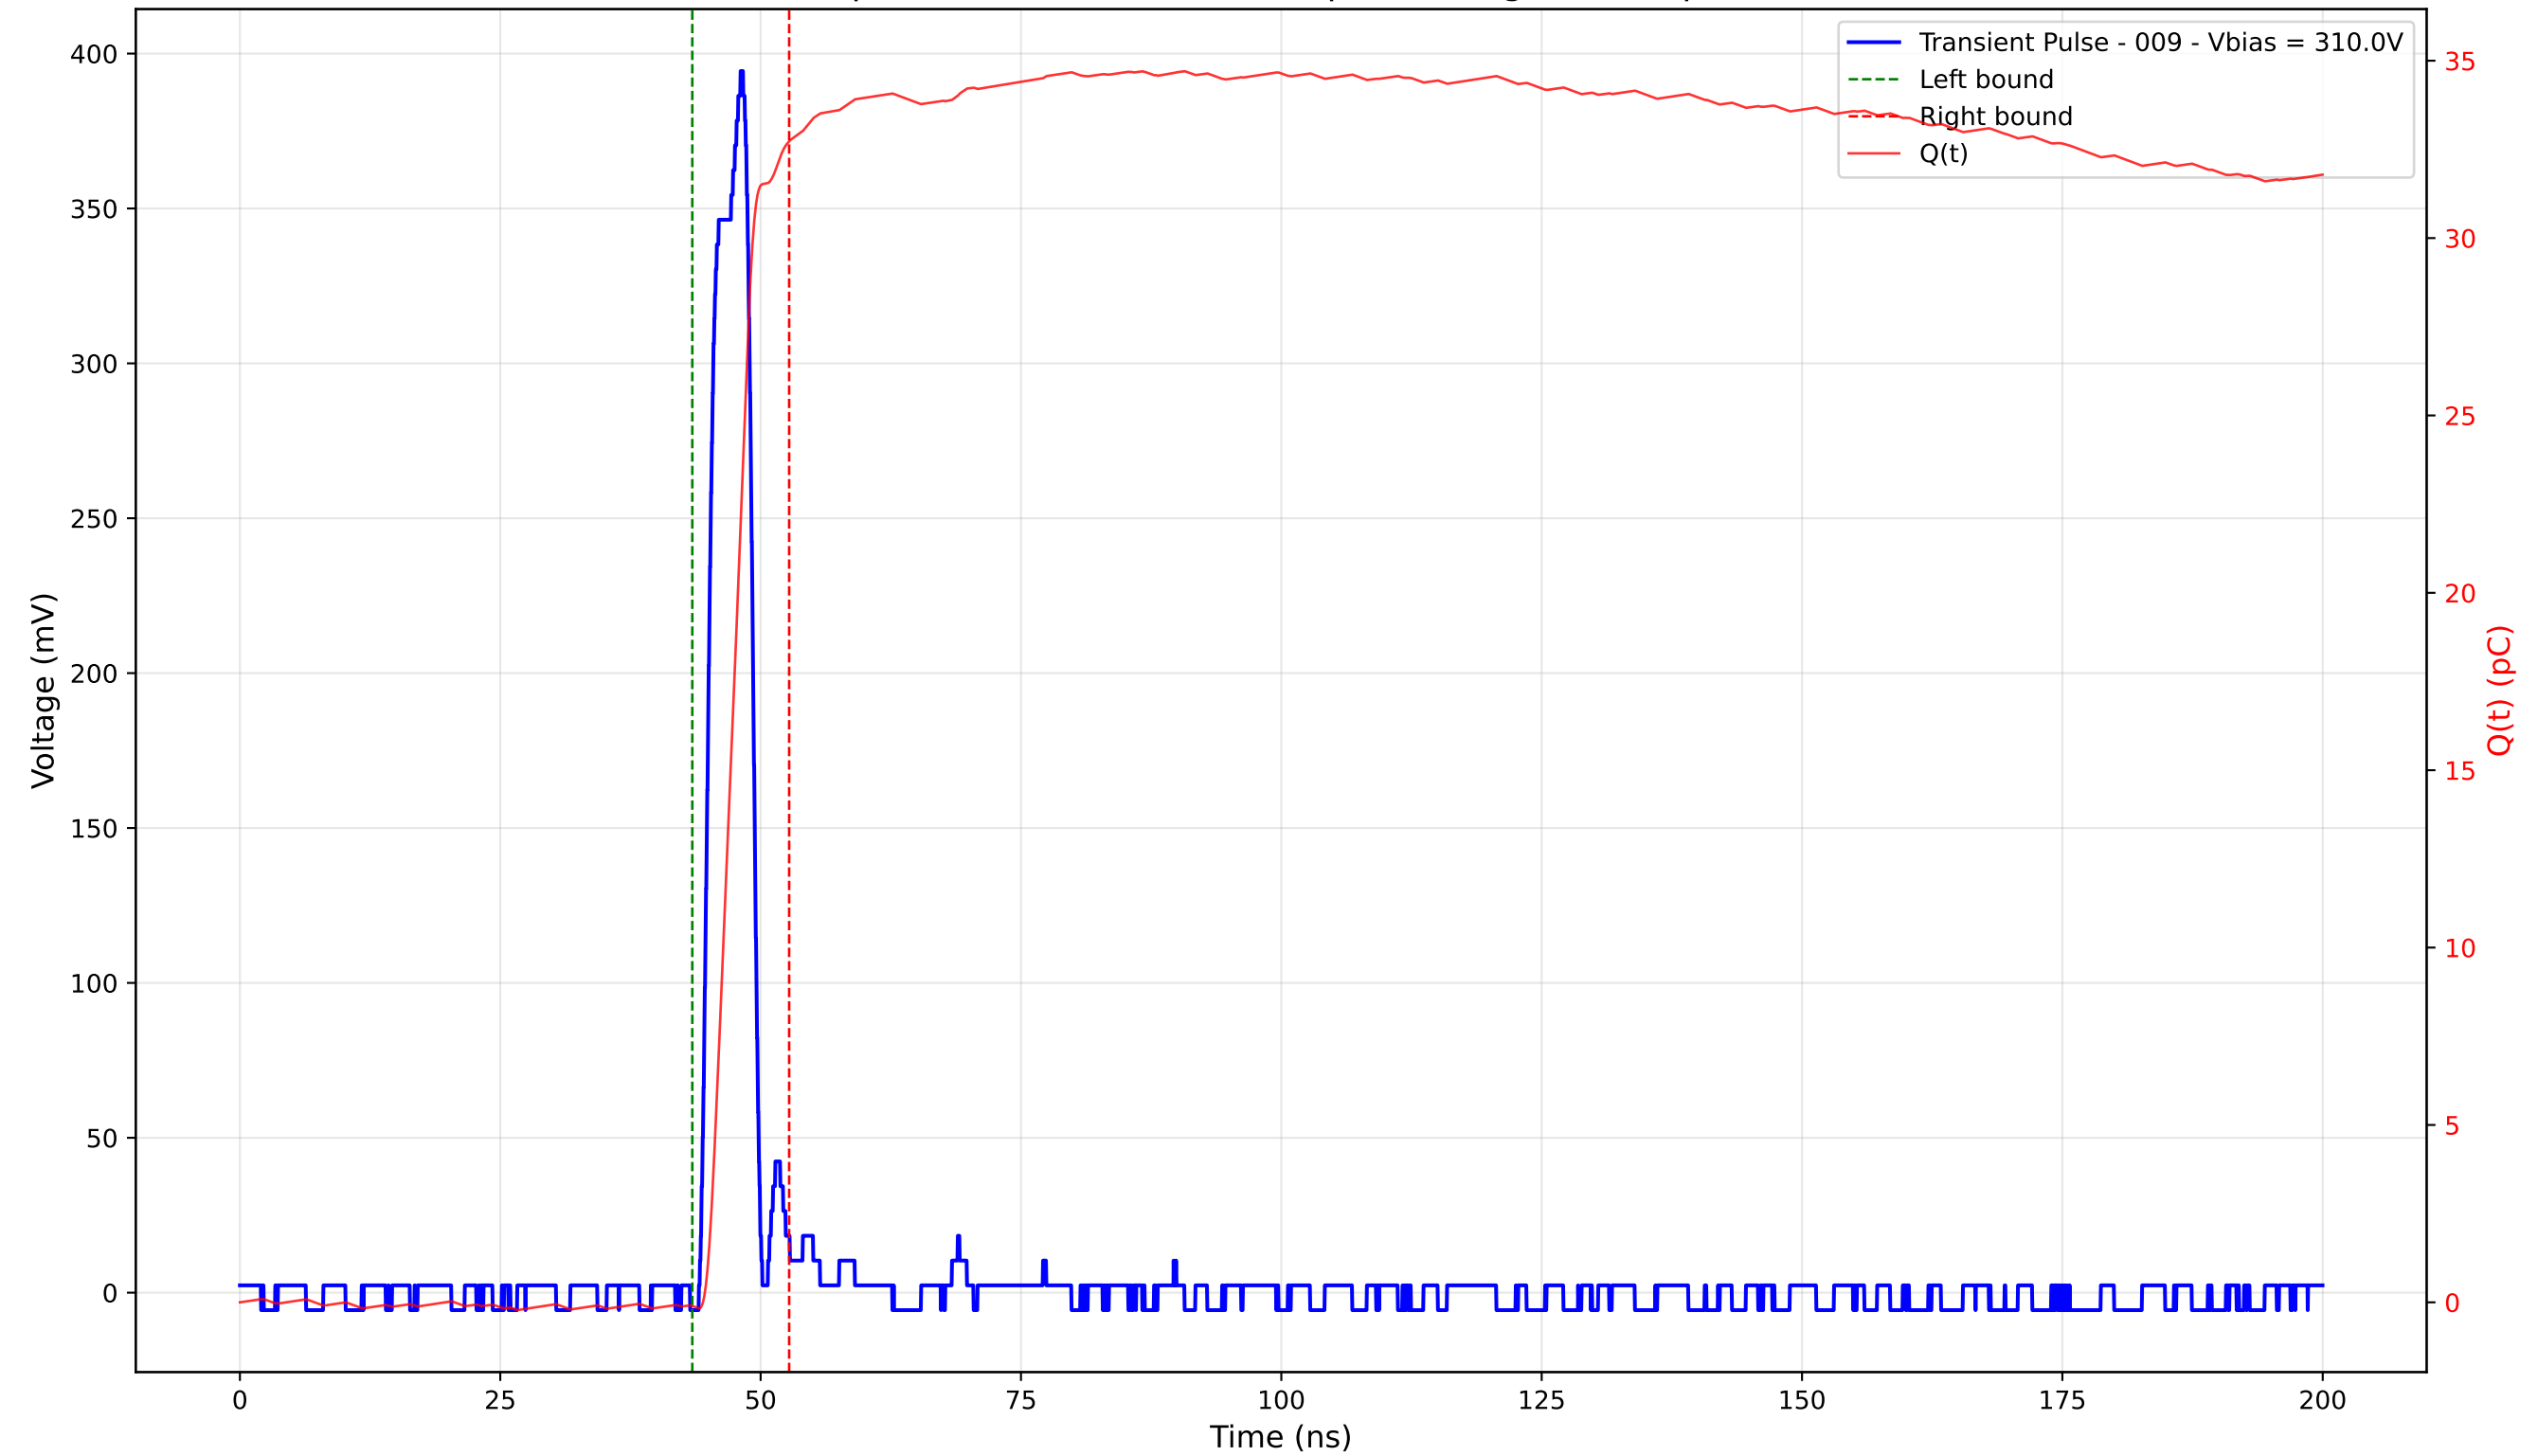


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 31.43 pC - Rise Time: 3.03 ns

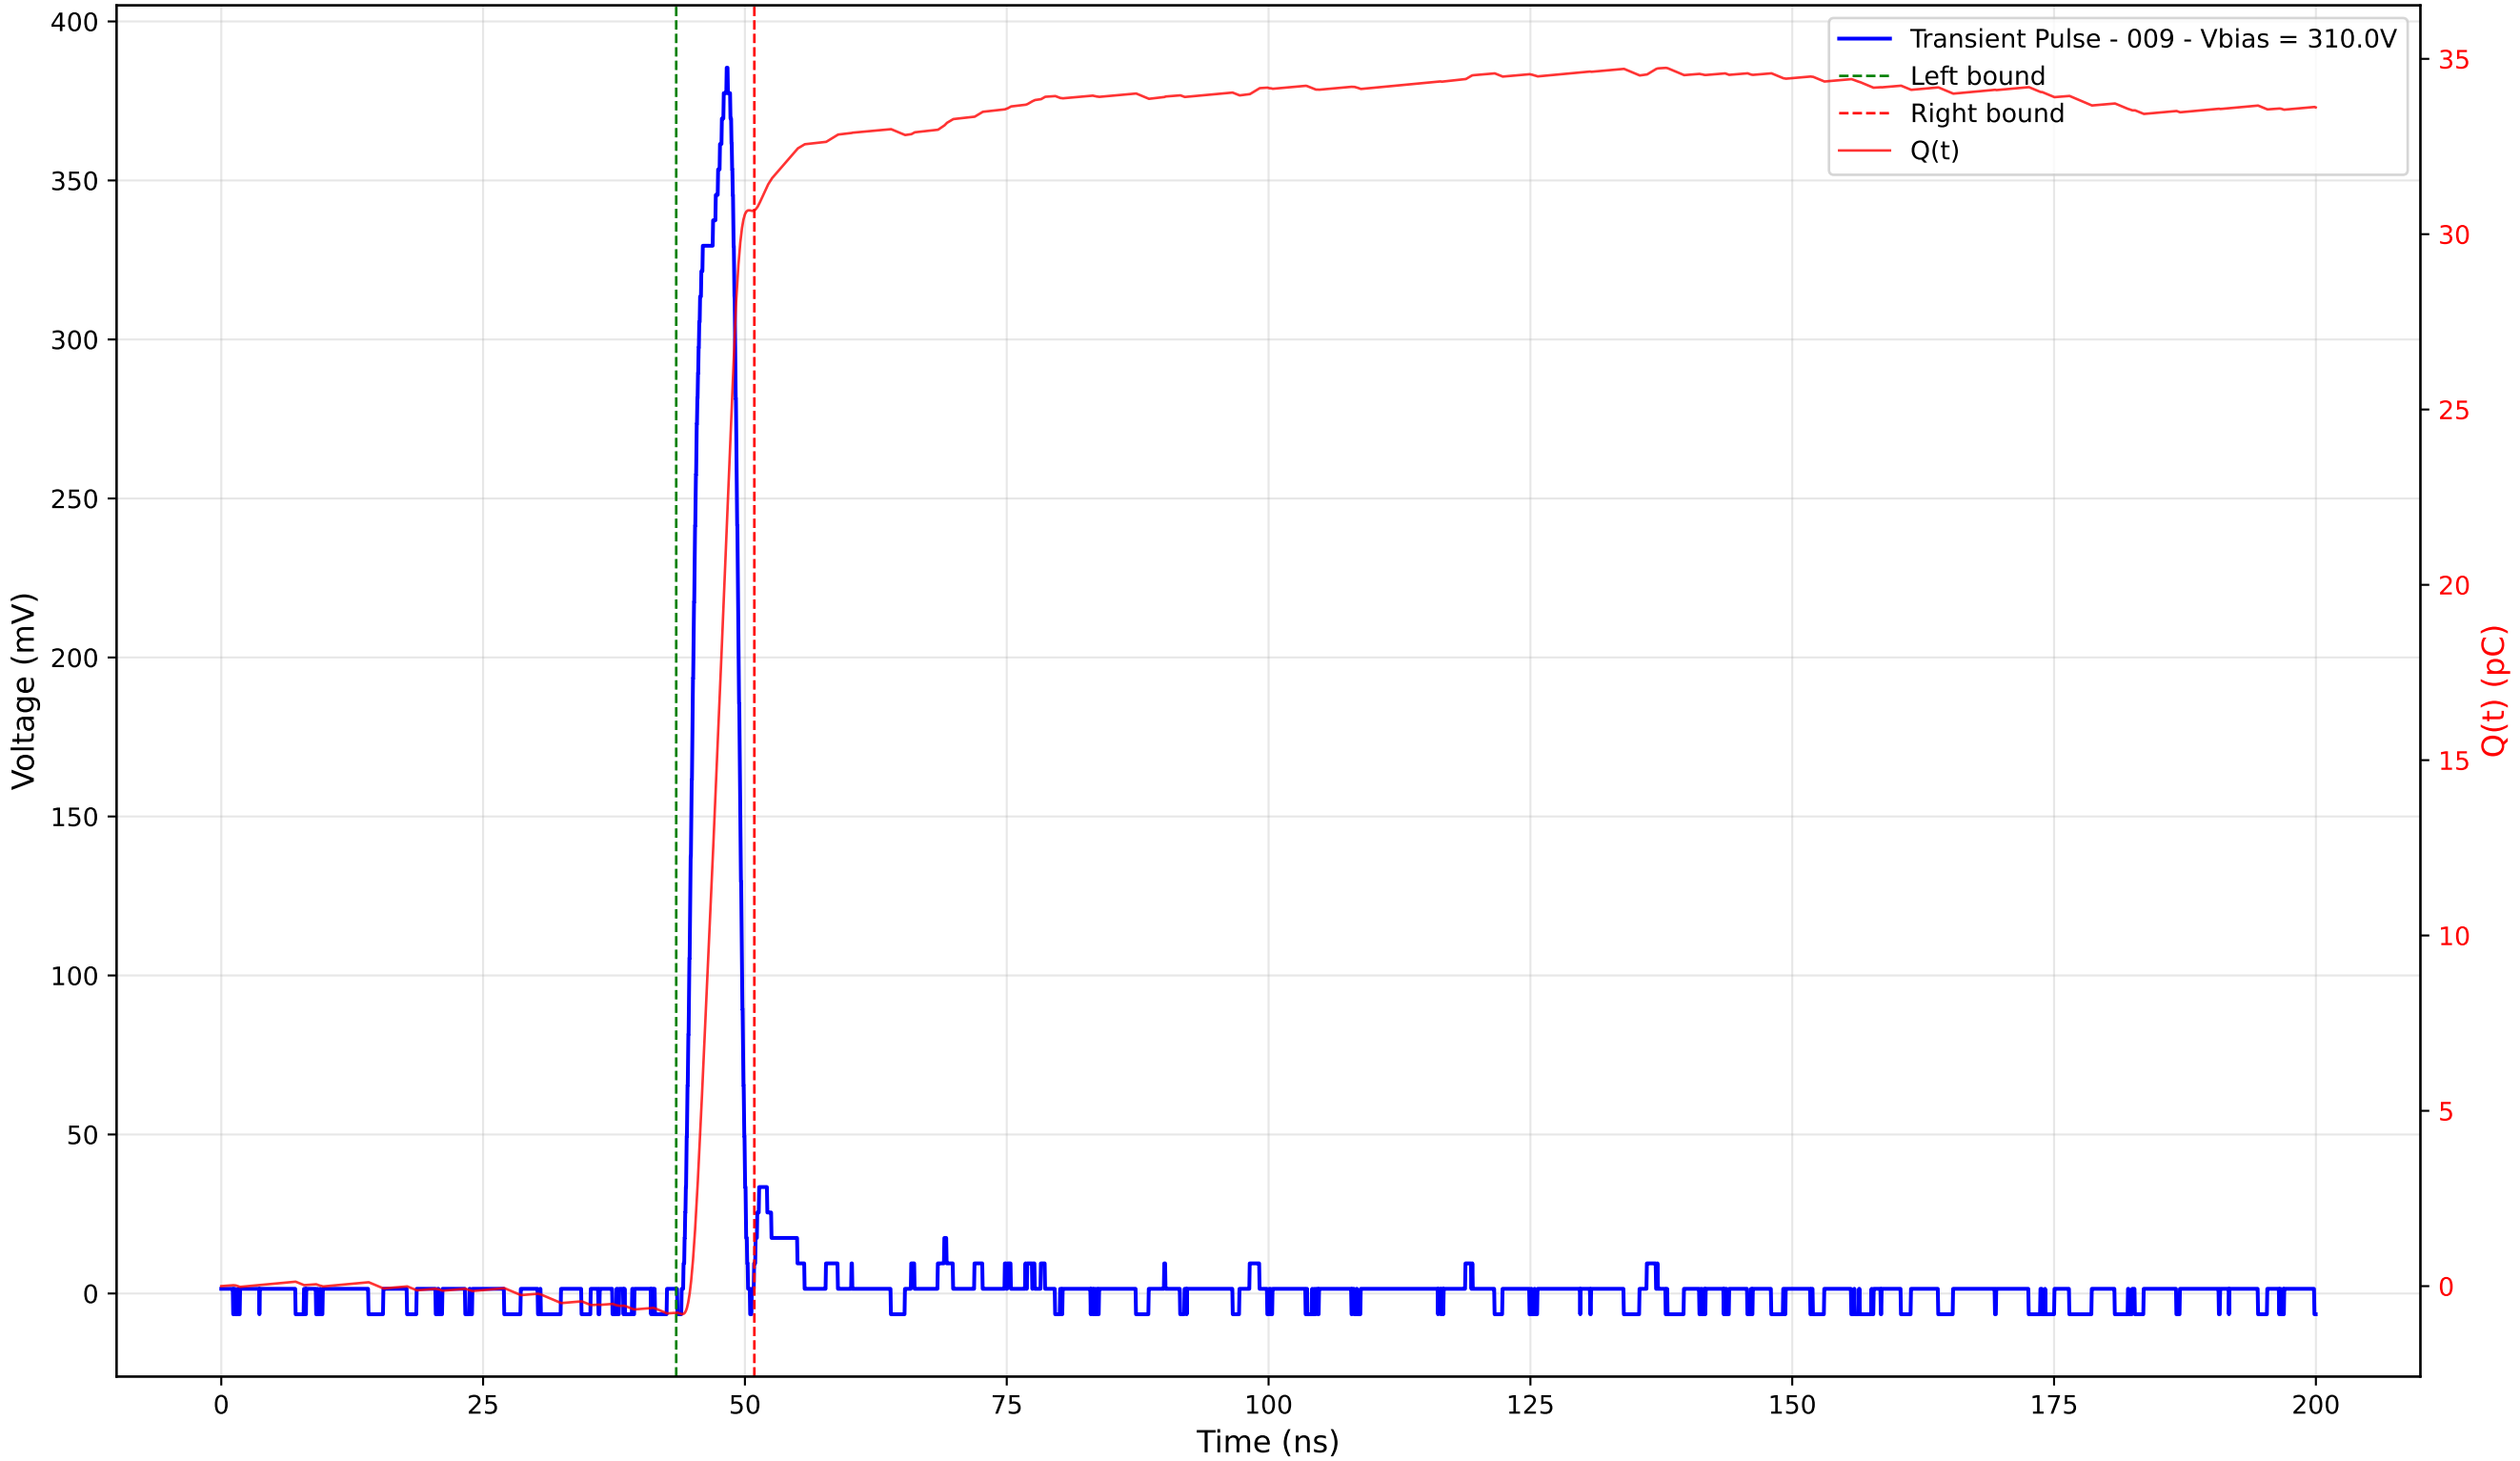


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 32.04 pC - Rise Time: 2.91 ns

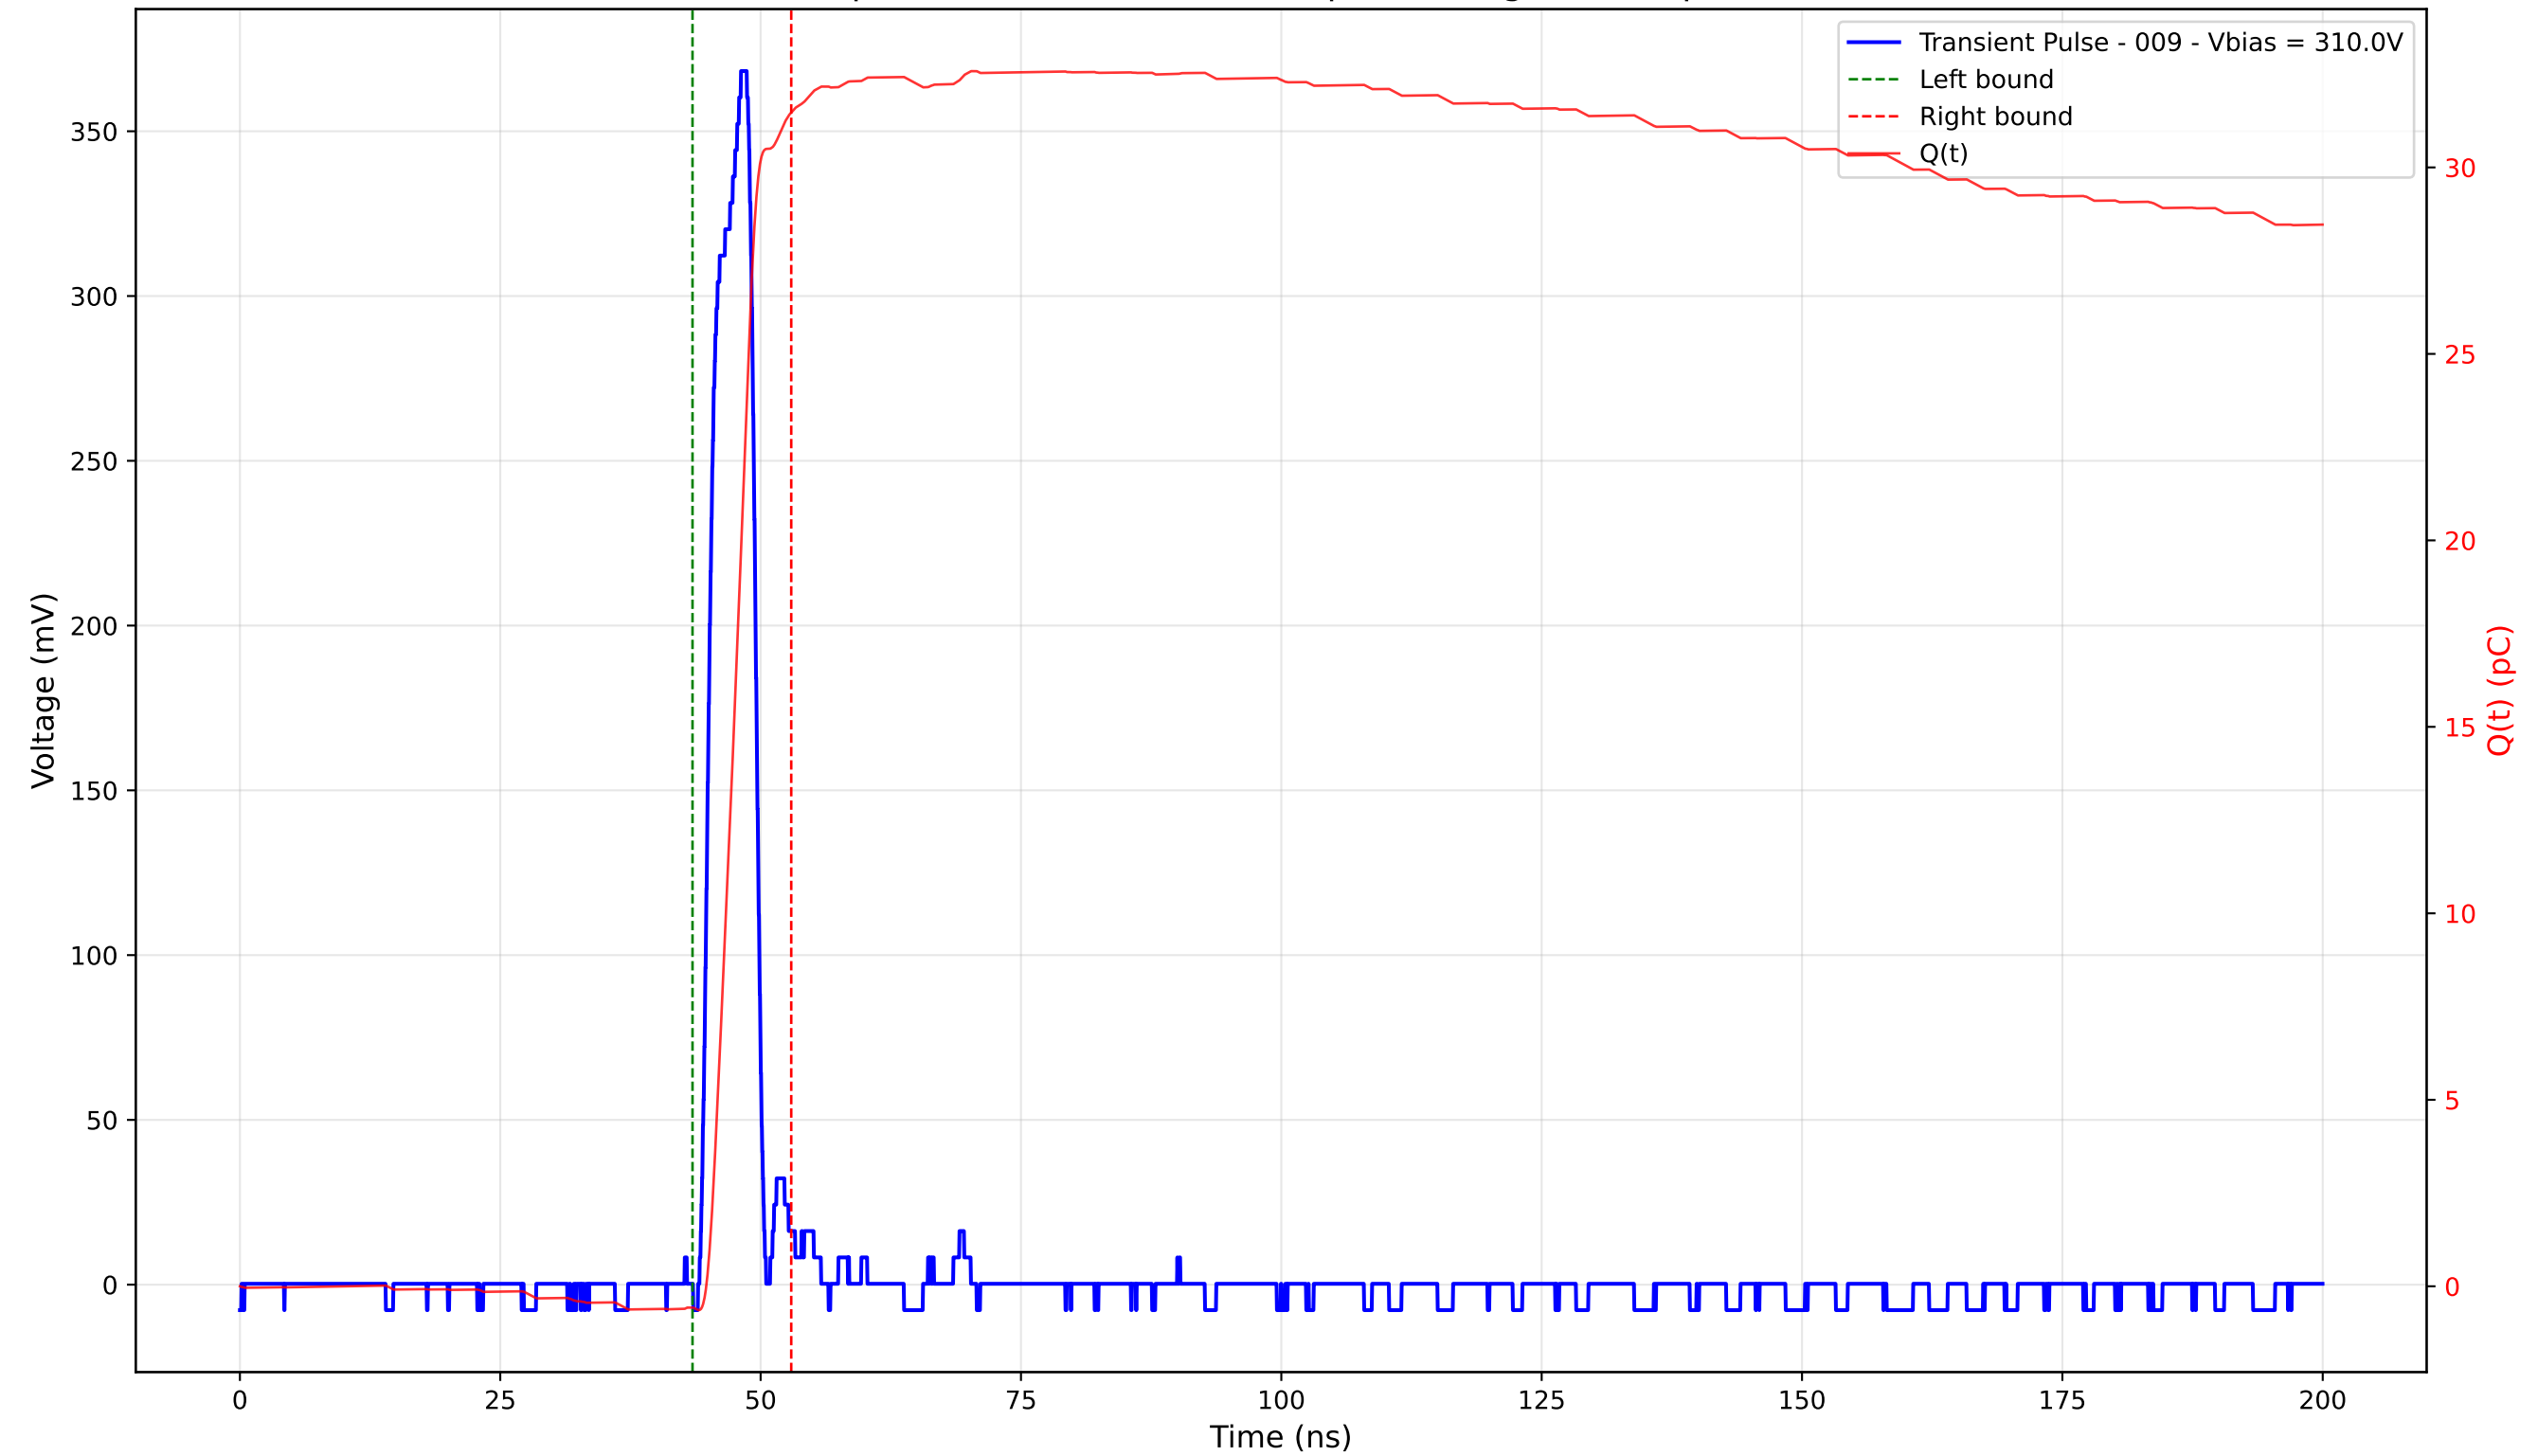


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 32.37 pC - Rise Time: 3.02 ns

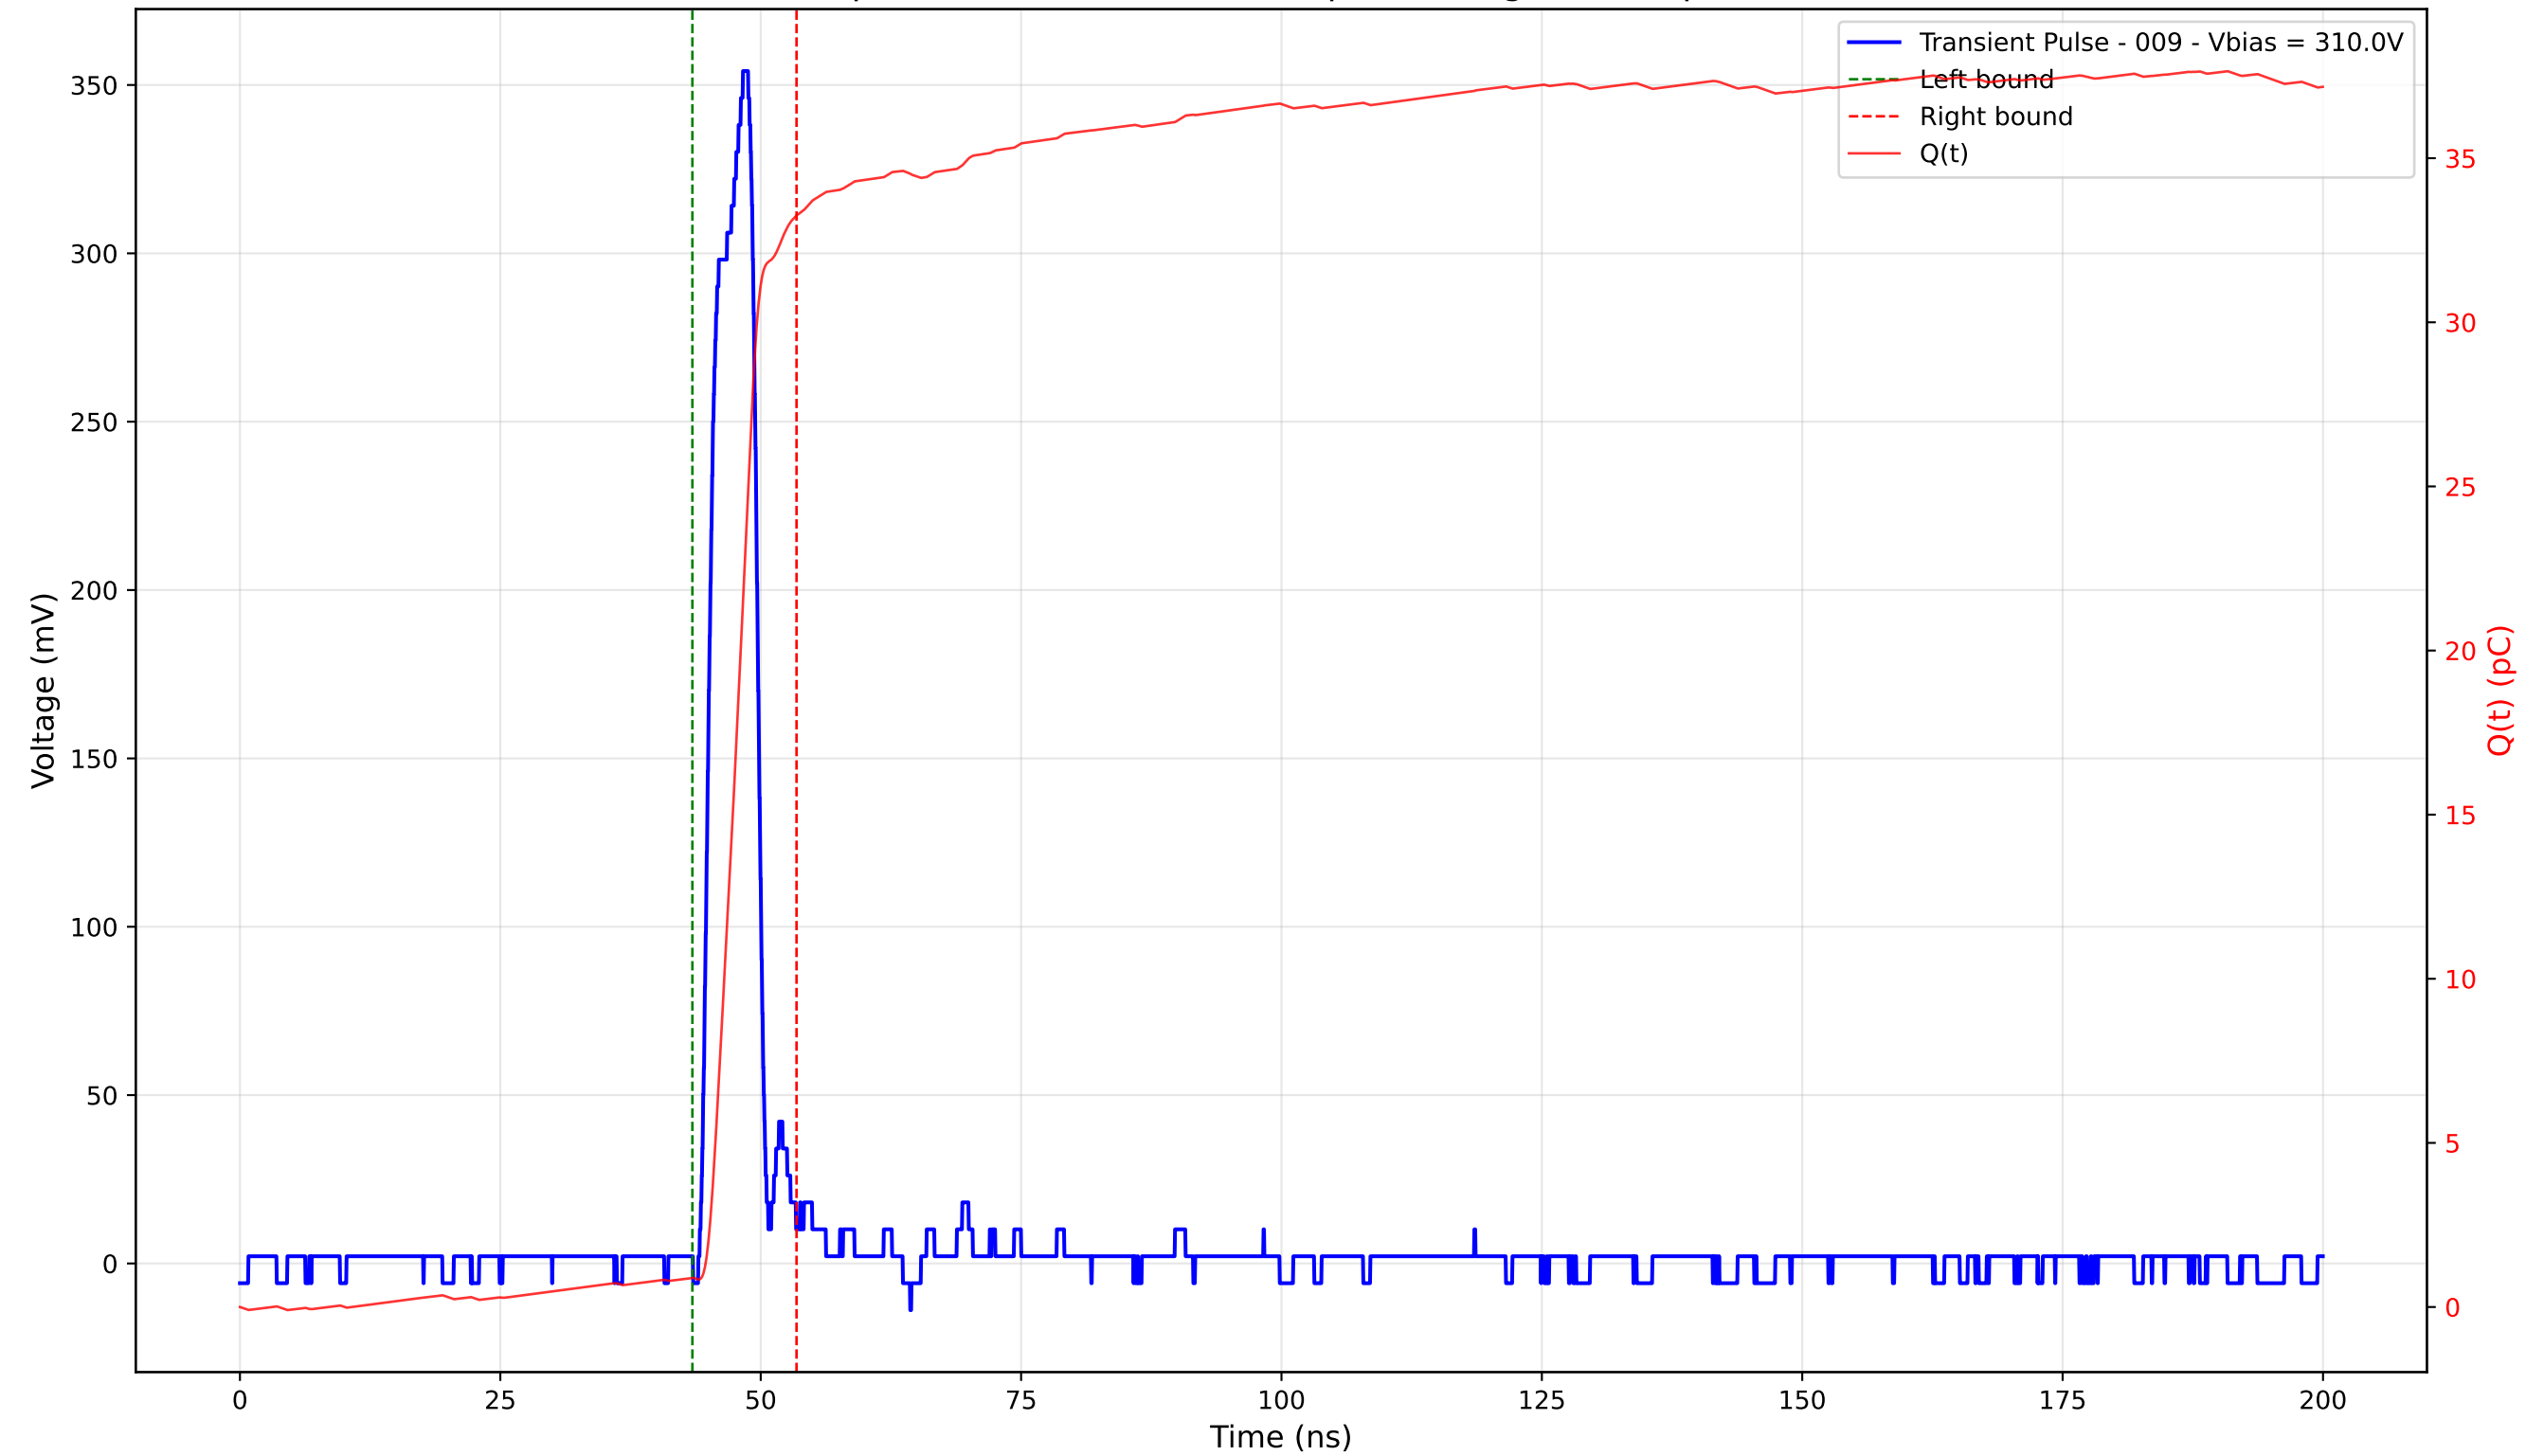


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 30.86 pC - Rise Time: 3.06 ns

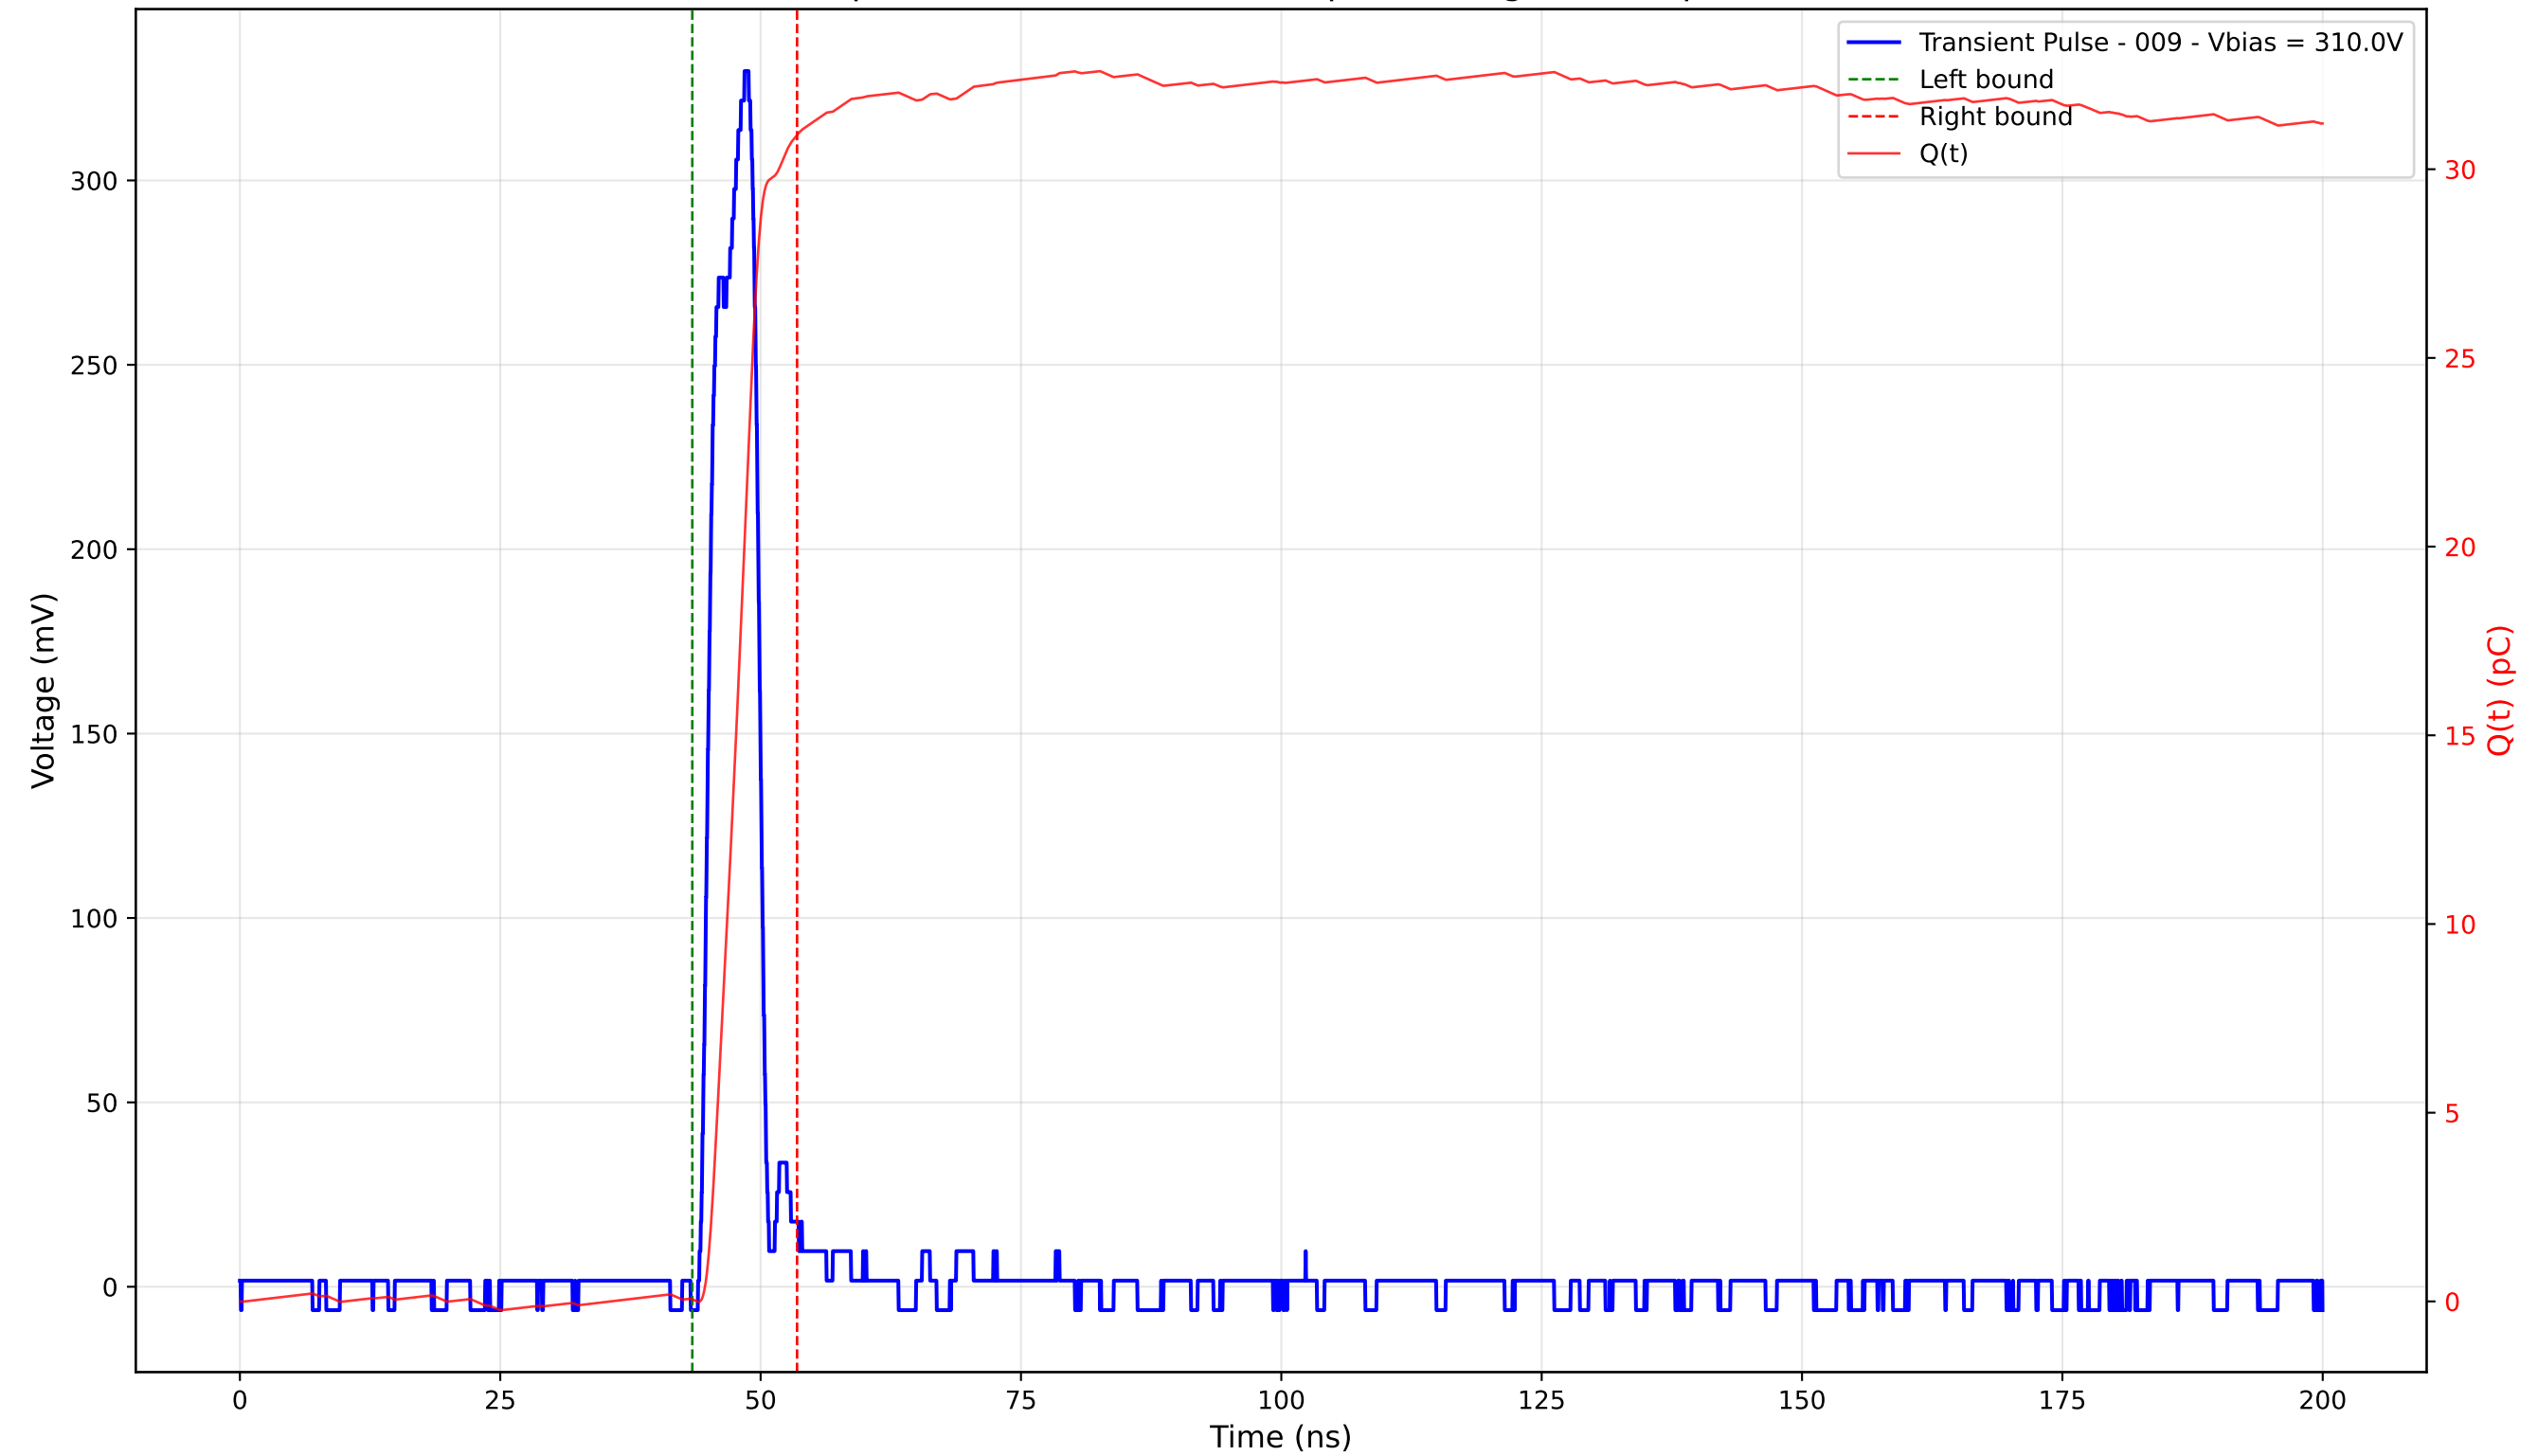


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 27.60 pC - Rise Time: 3.29 ns

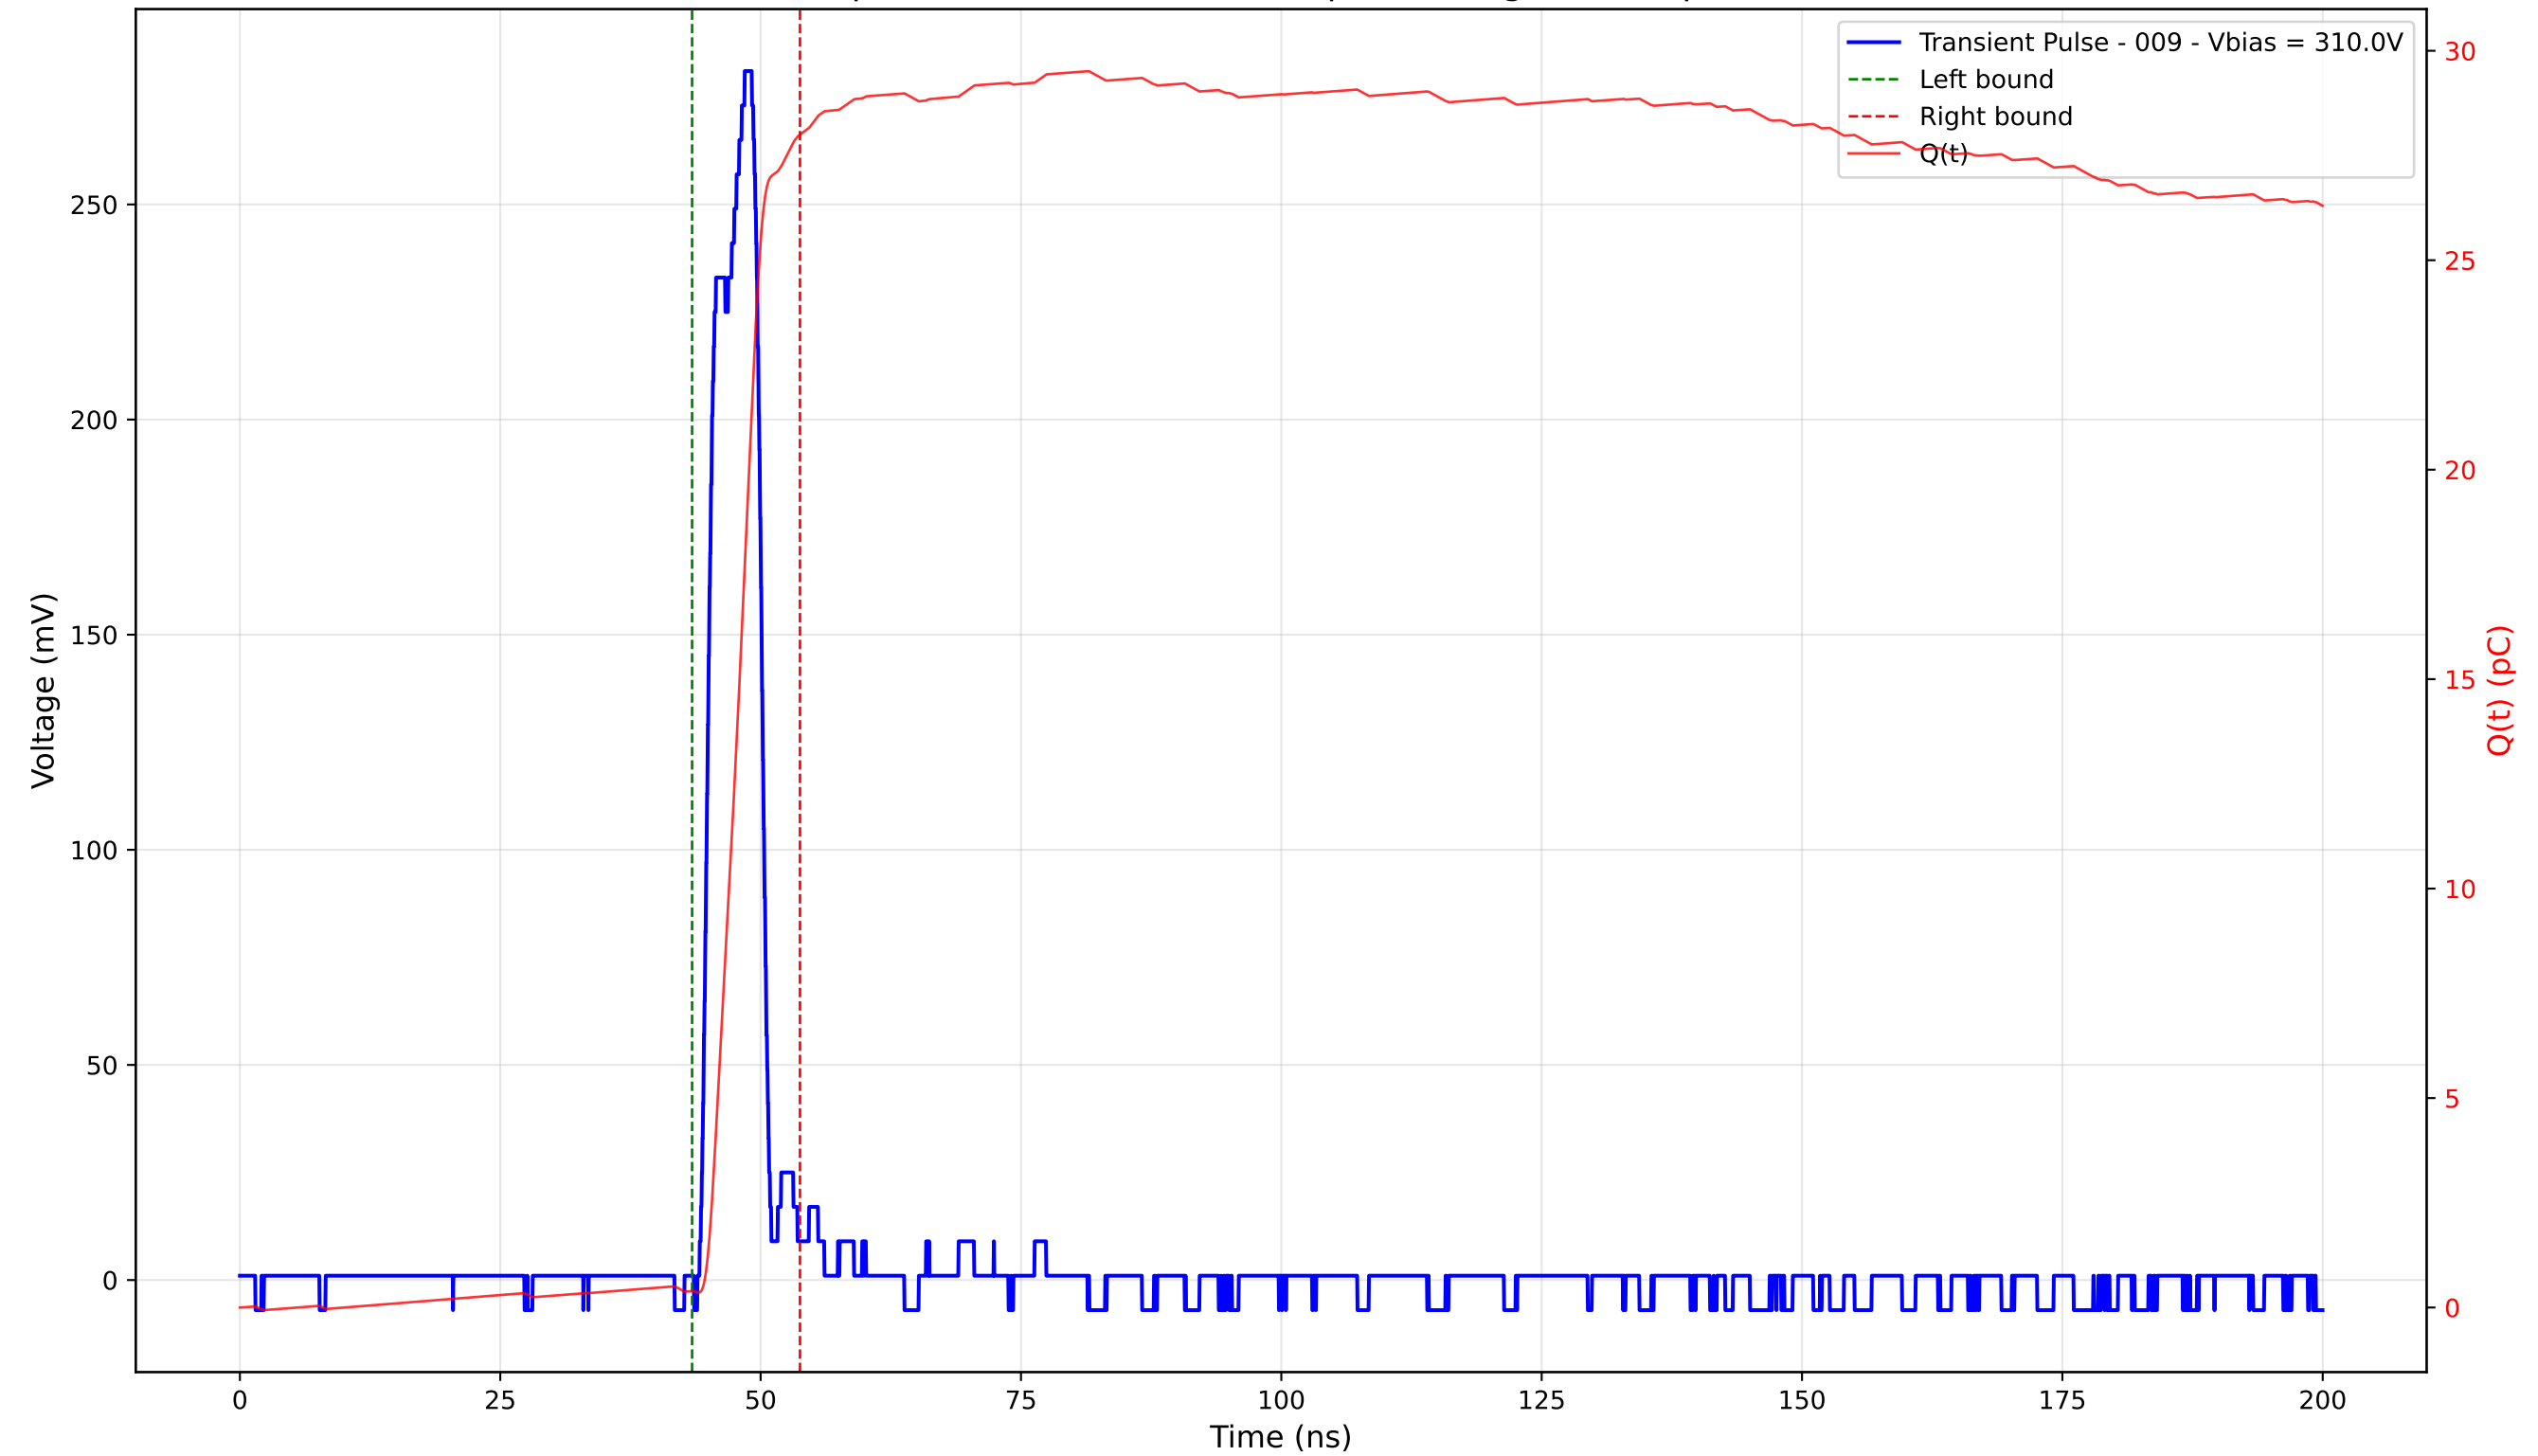


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 23.26 pC - Rise Time: 3.35 ns

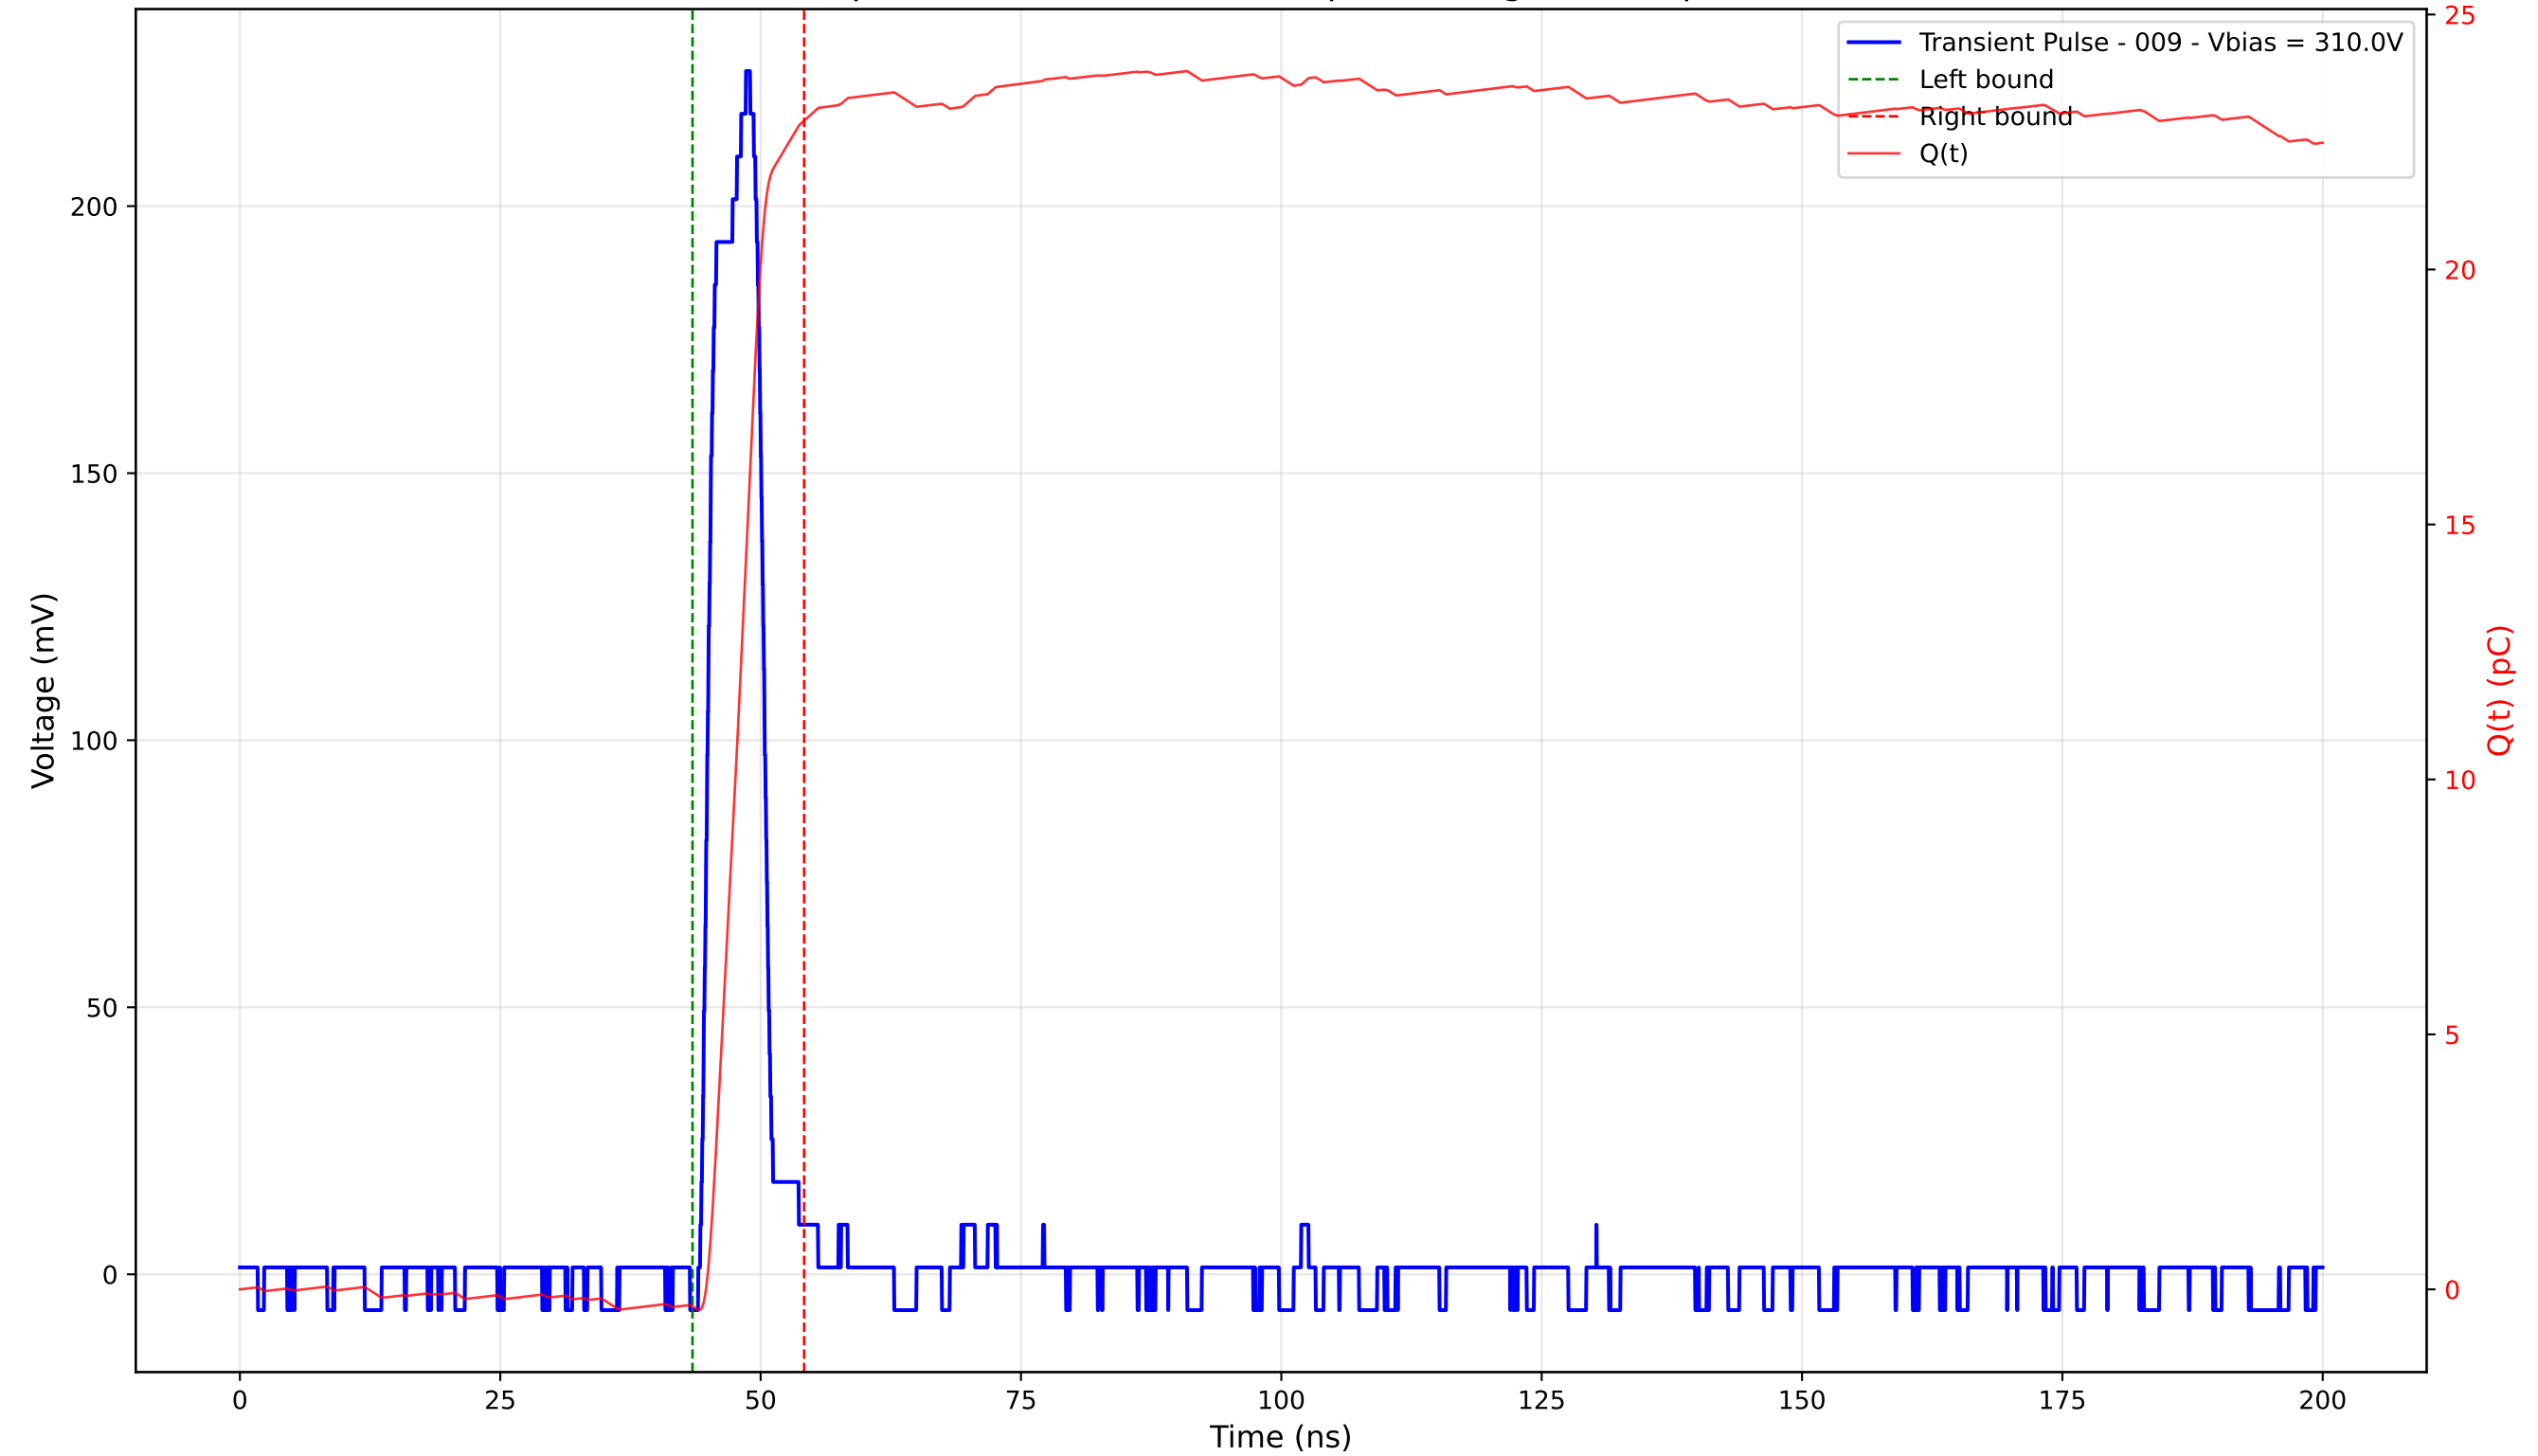


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 18.46 pC - Rise Time: 1.26 ns

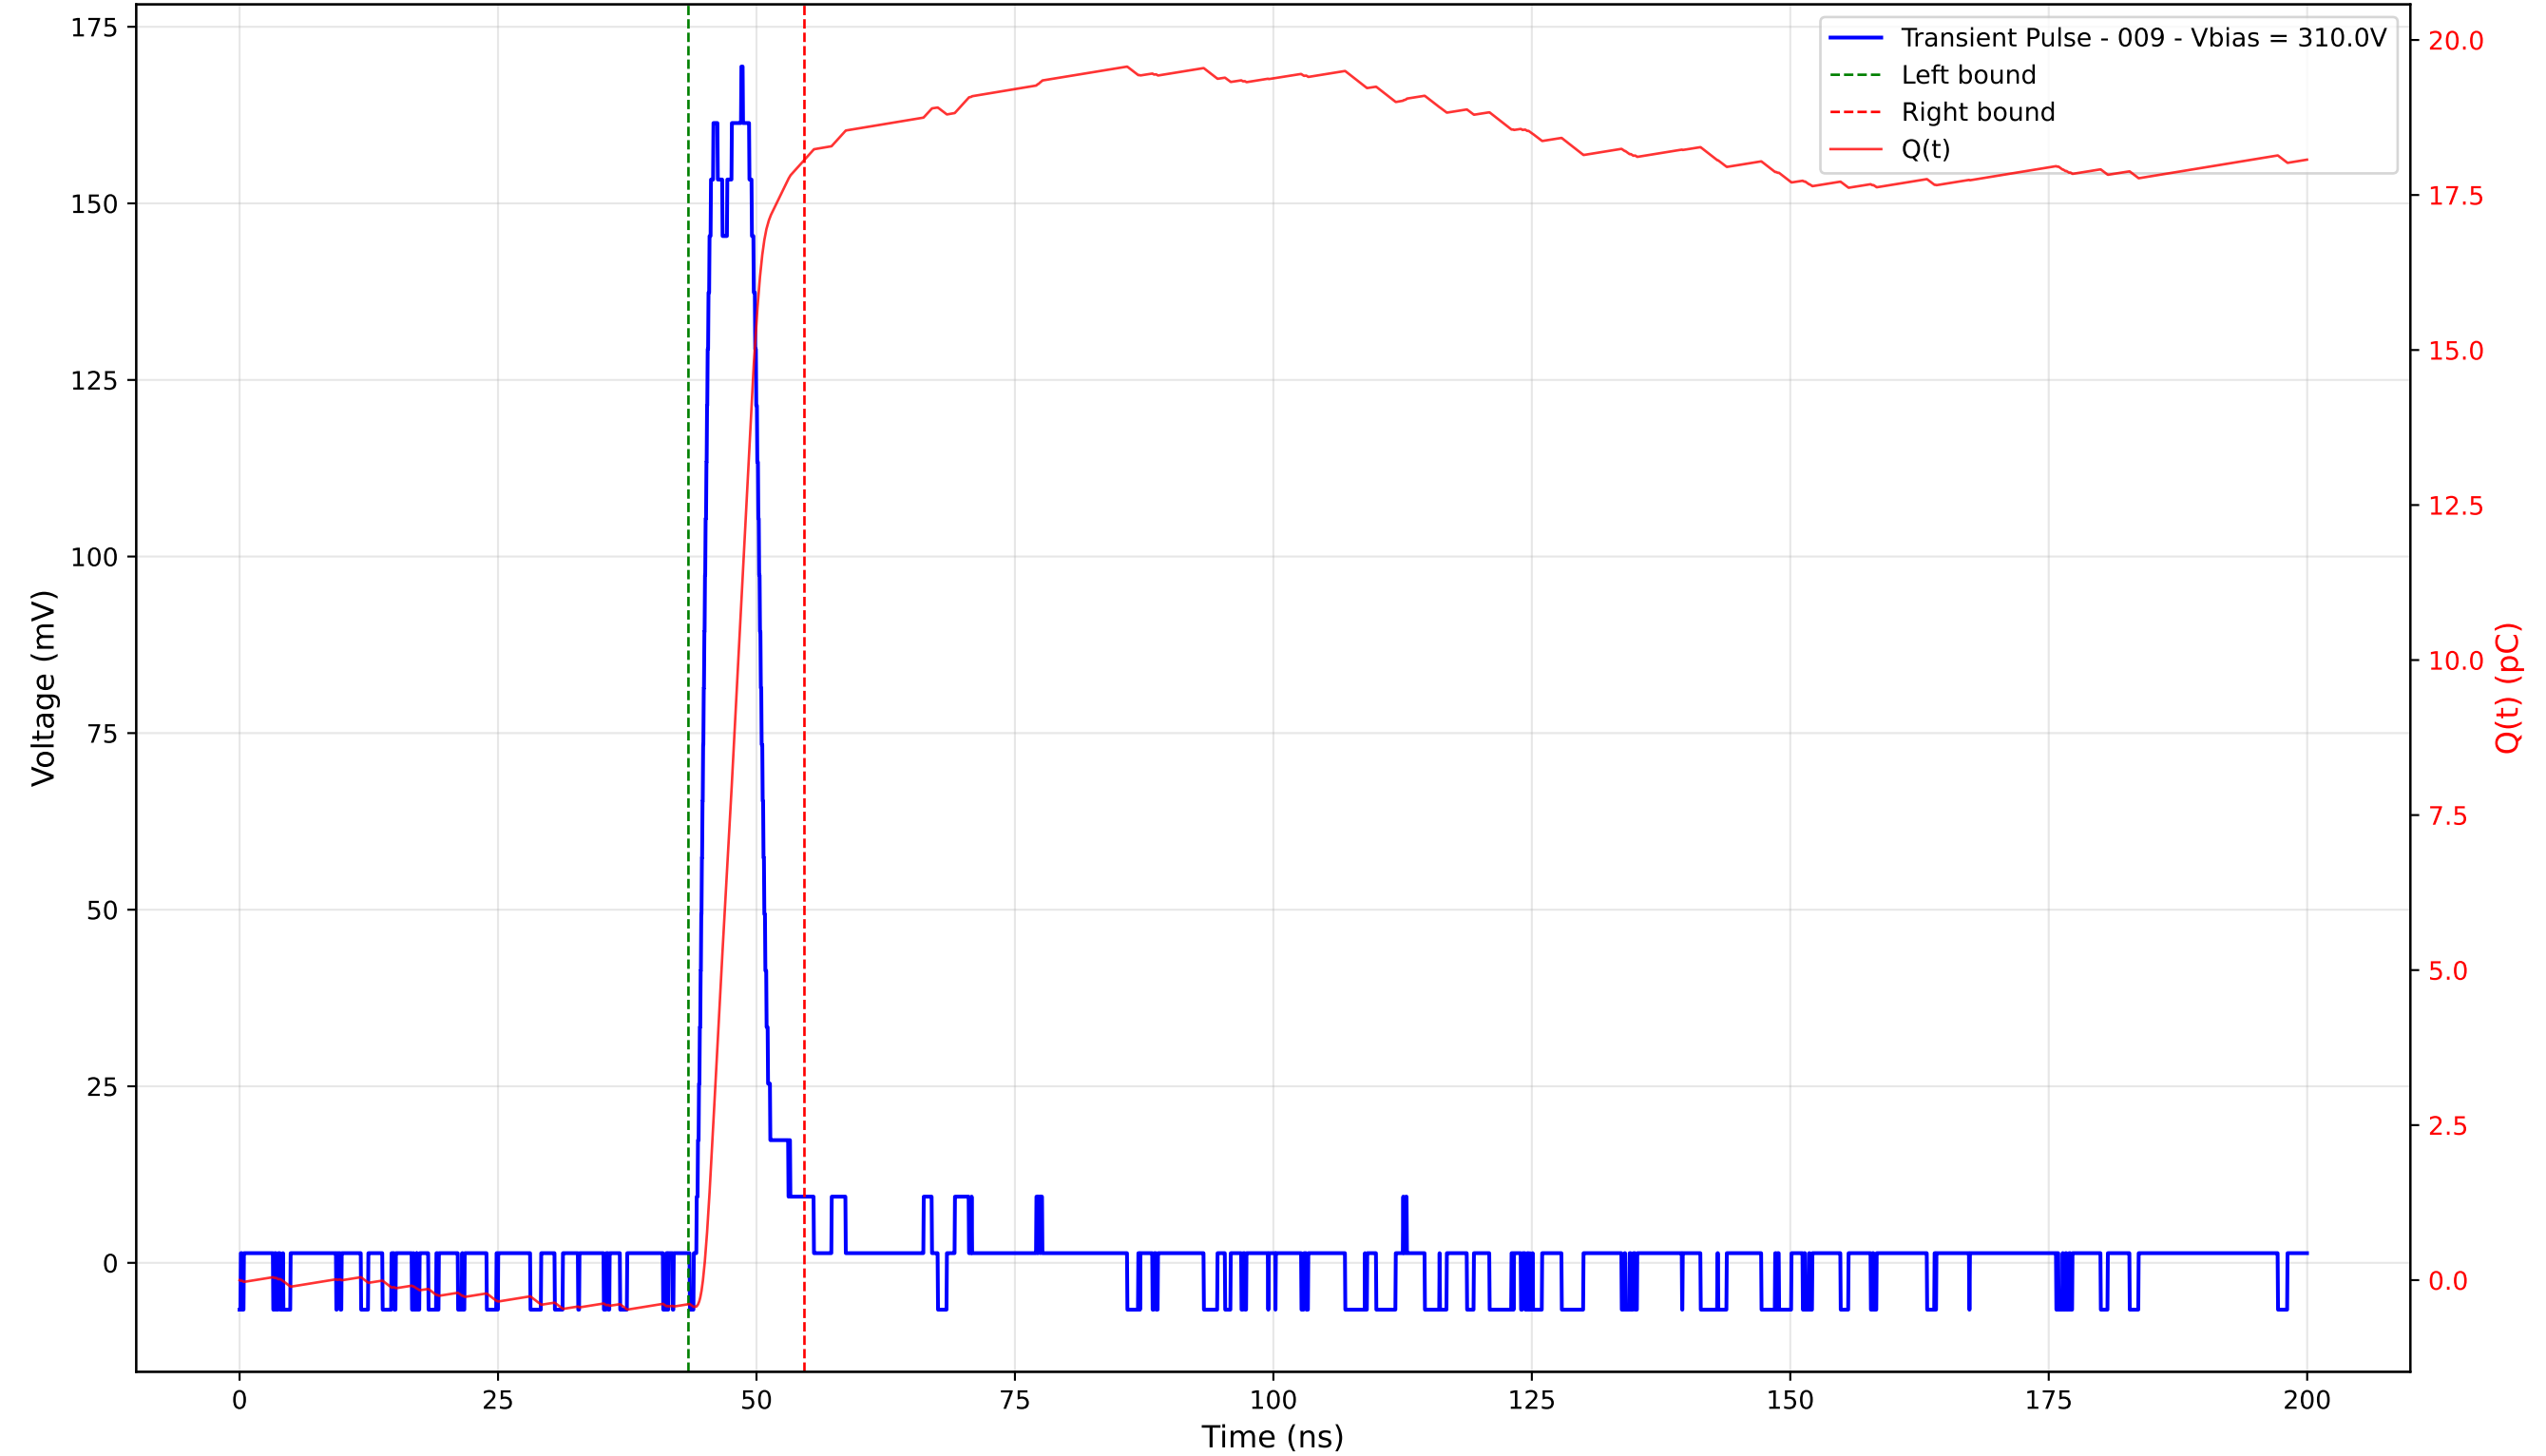


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 13.15 pC - Rise Time: 1.01 ns

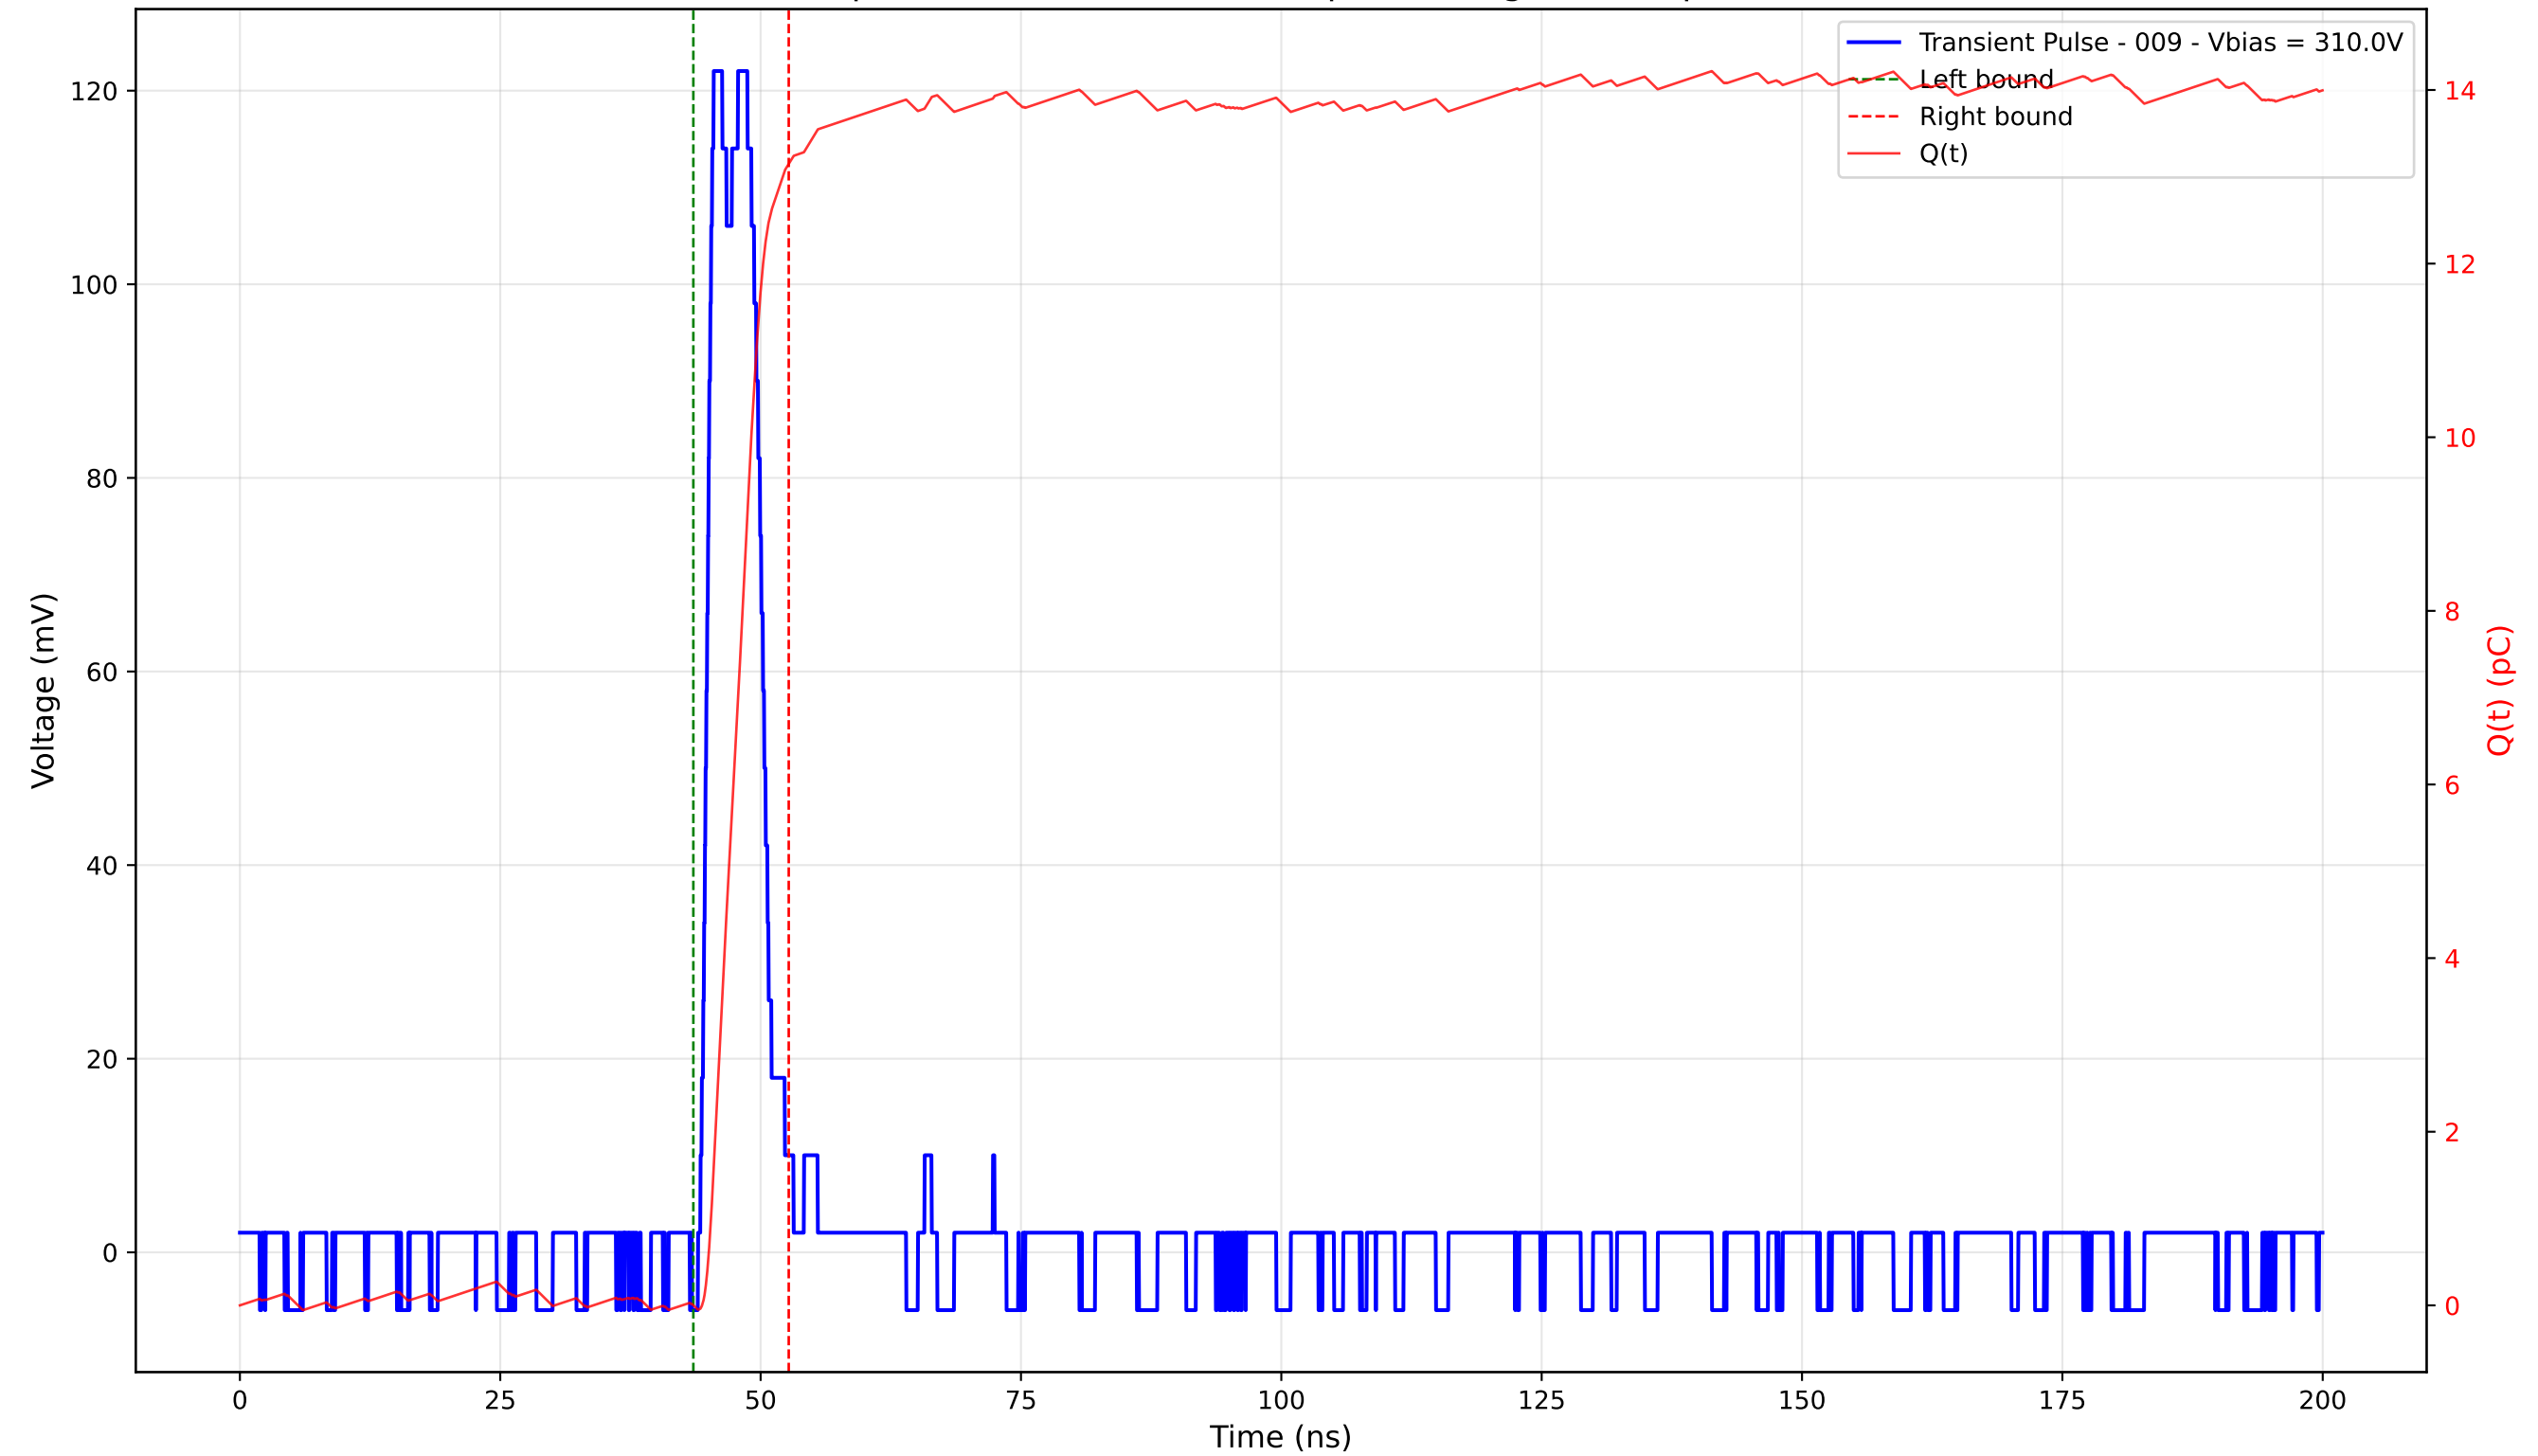


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 8.38 pC - Rise Time: 0.94 ns

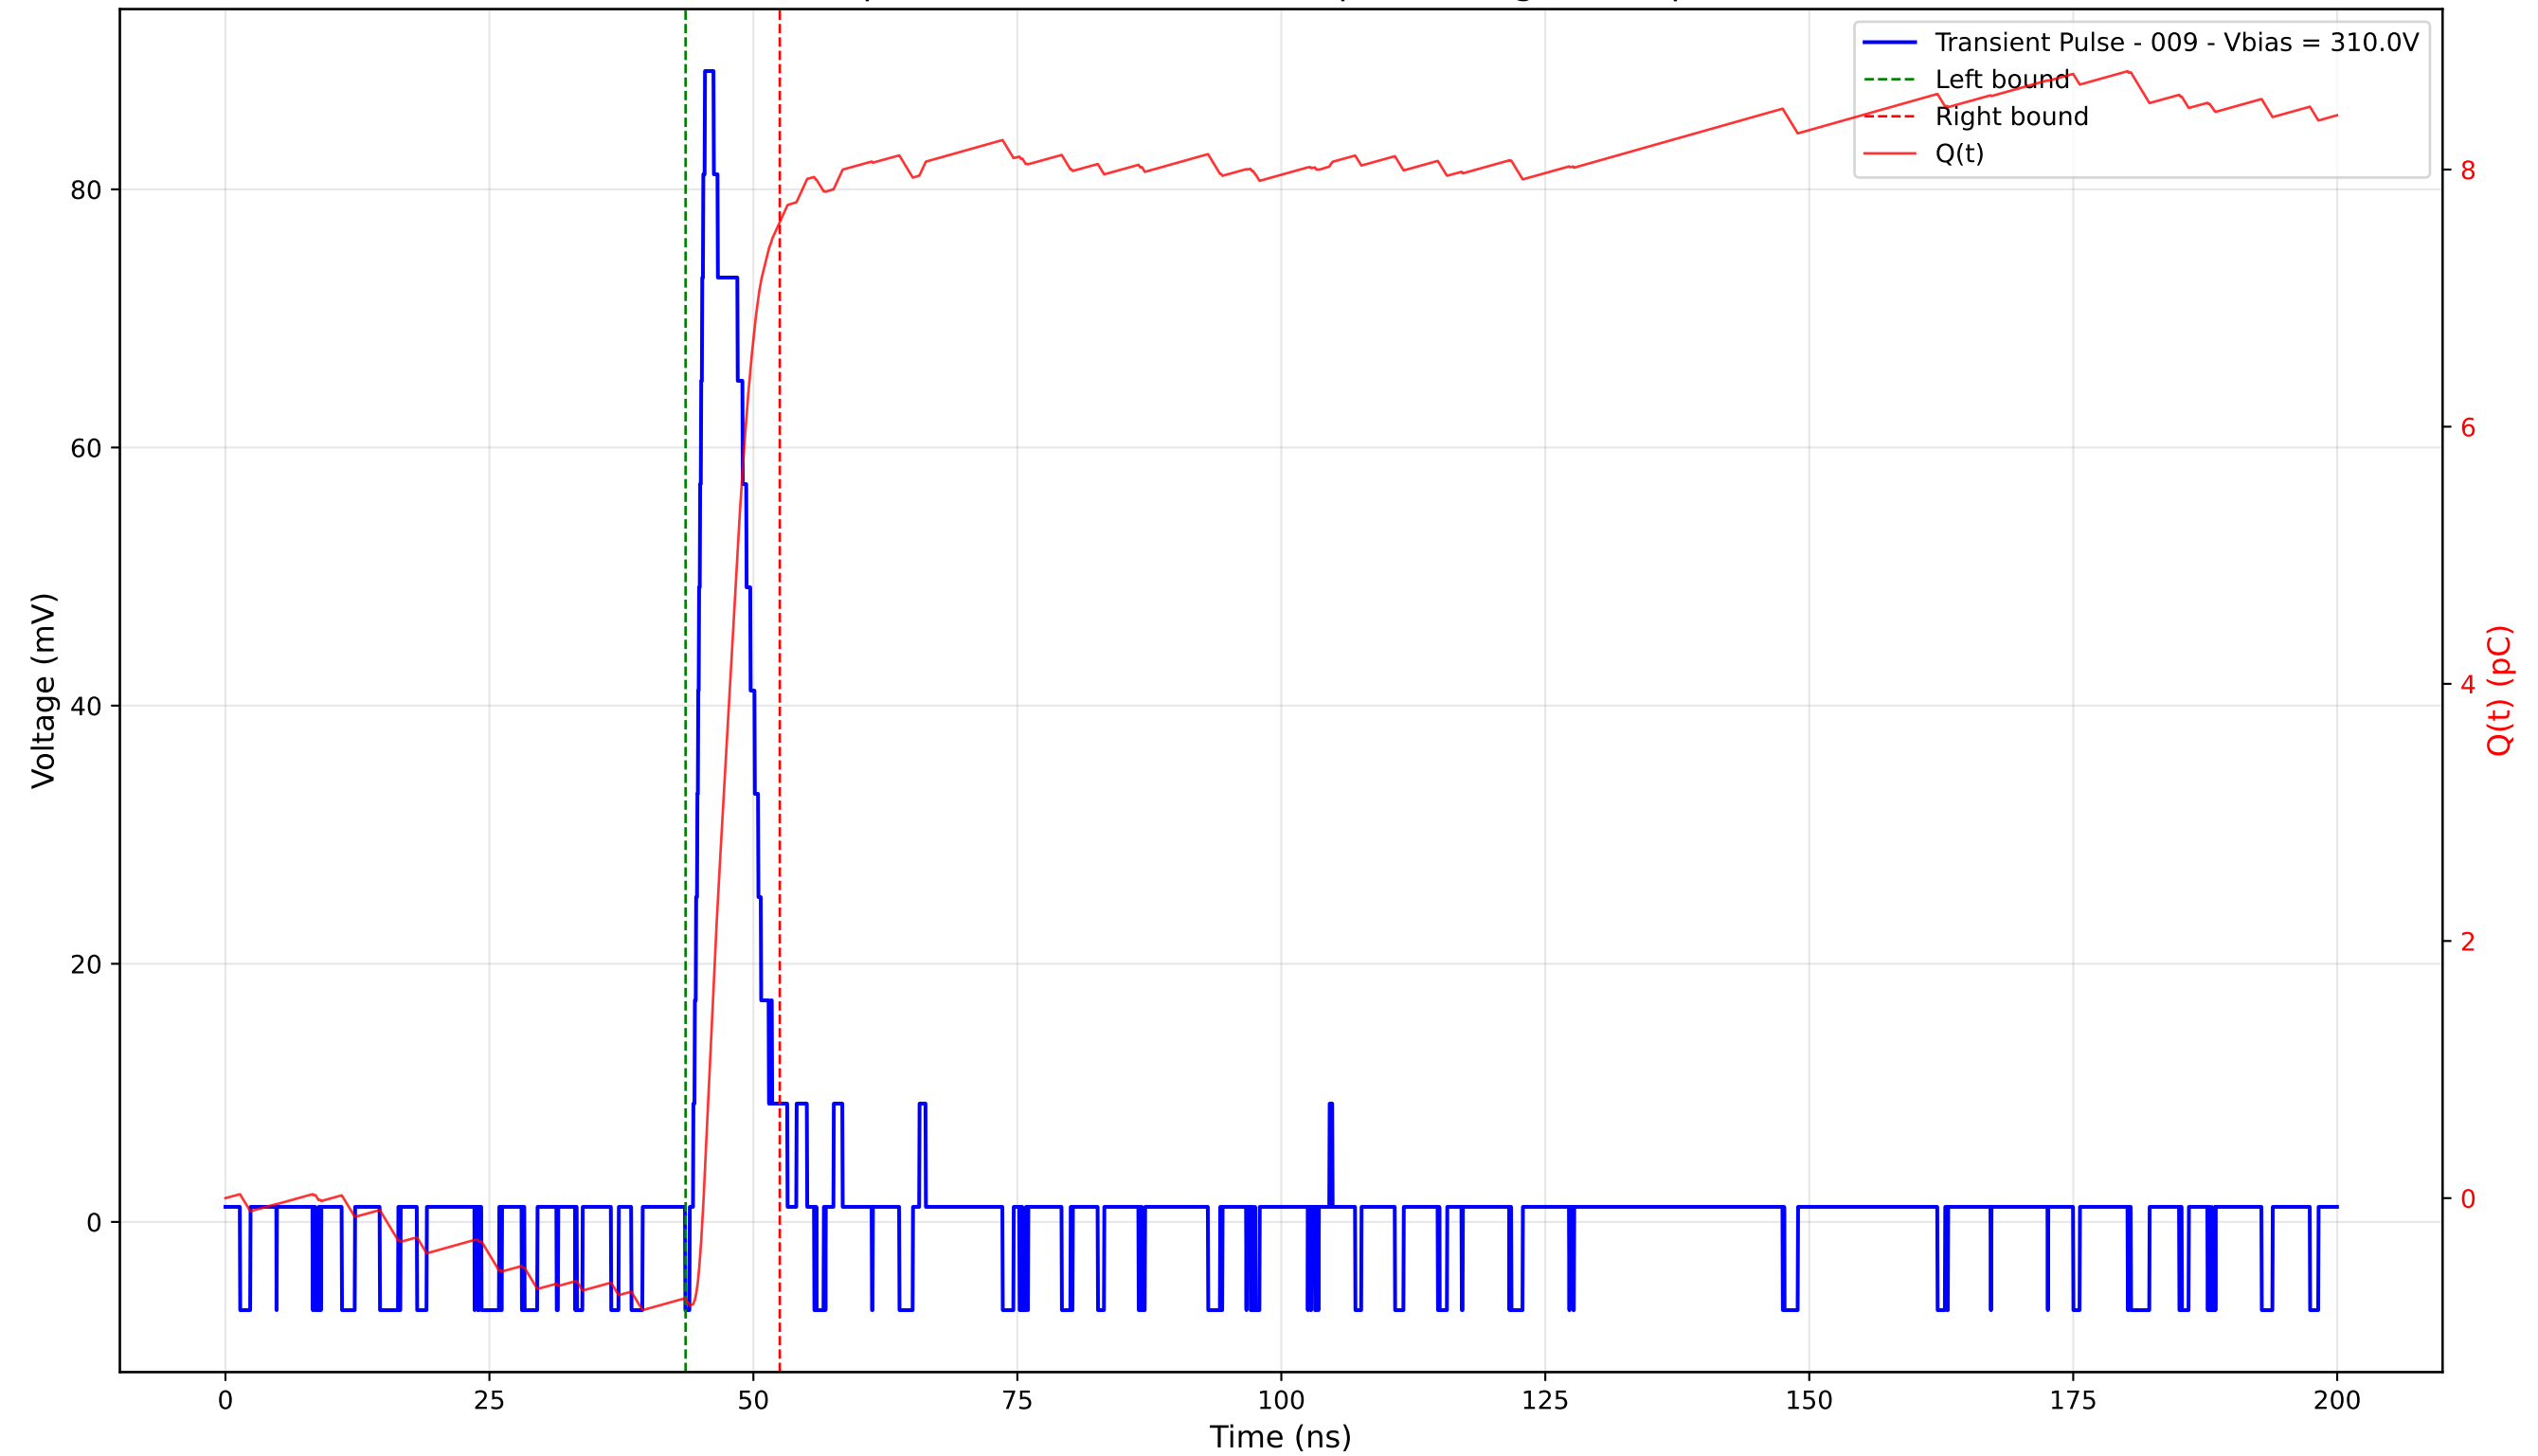


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 4.43 pC - Rise Time: 0.99 ns

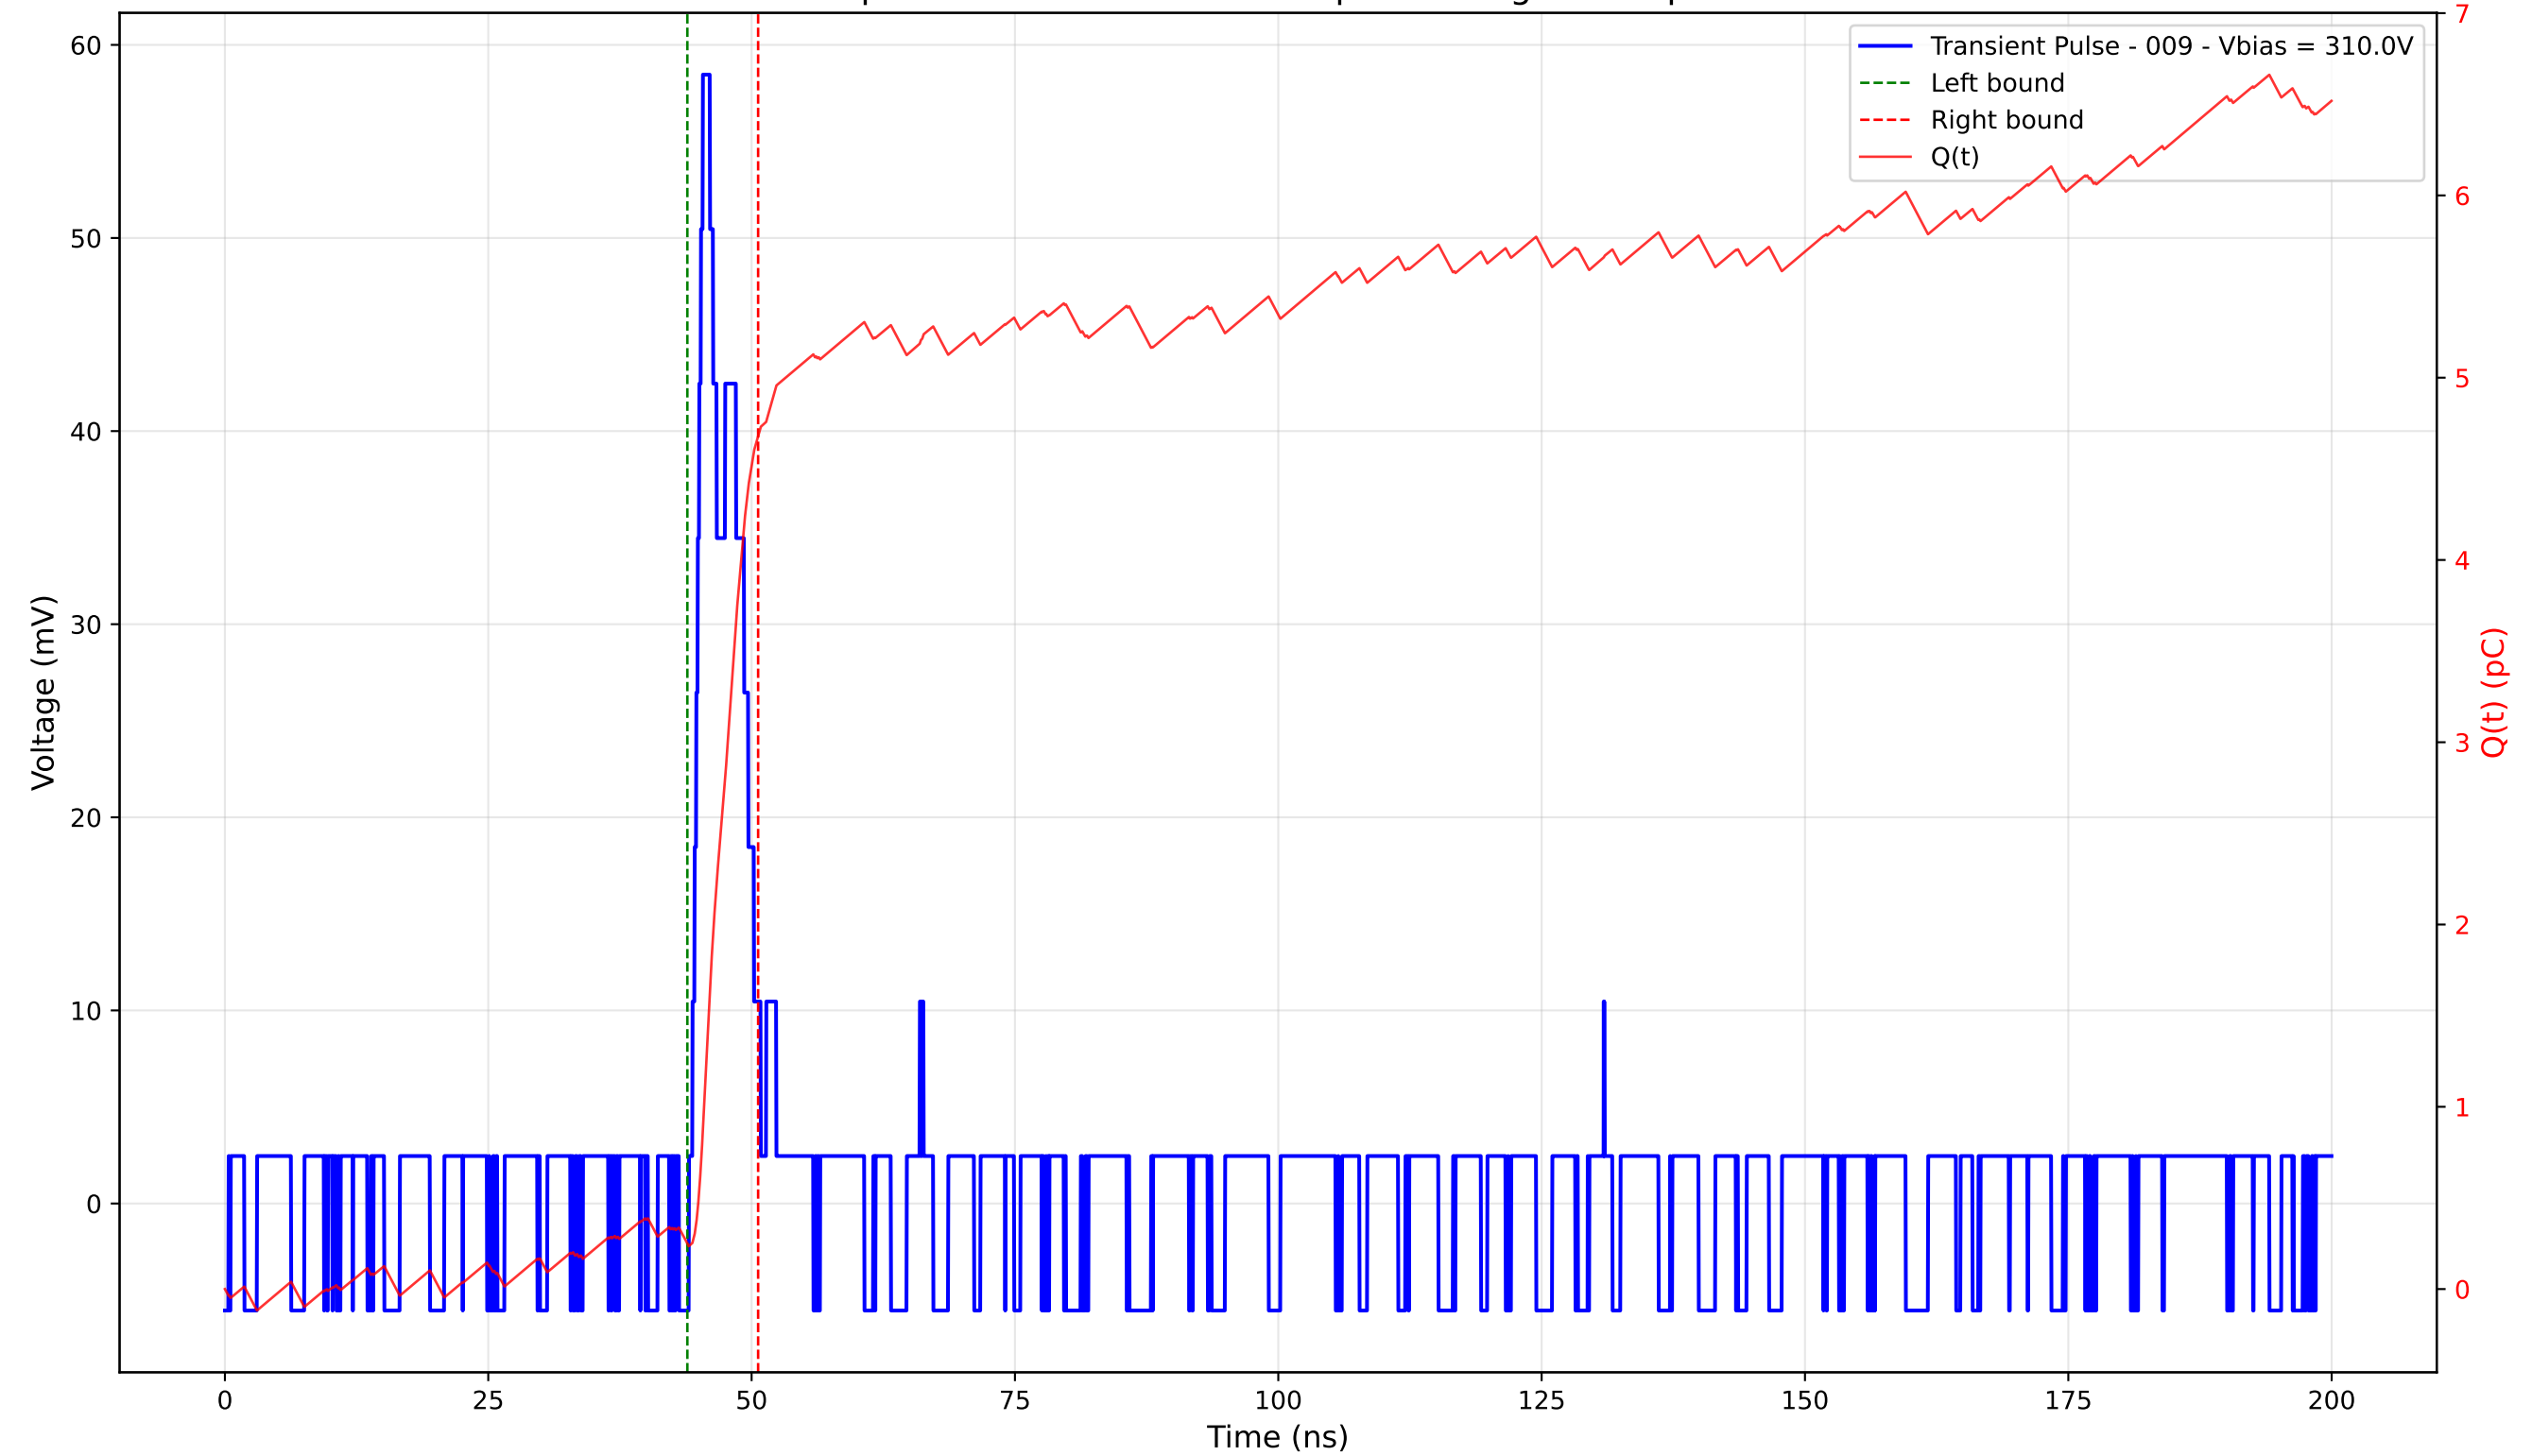

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.12 pC - Rise Time: 0.71 ns

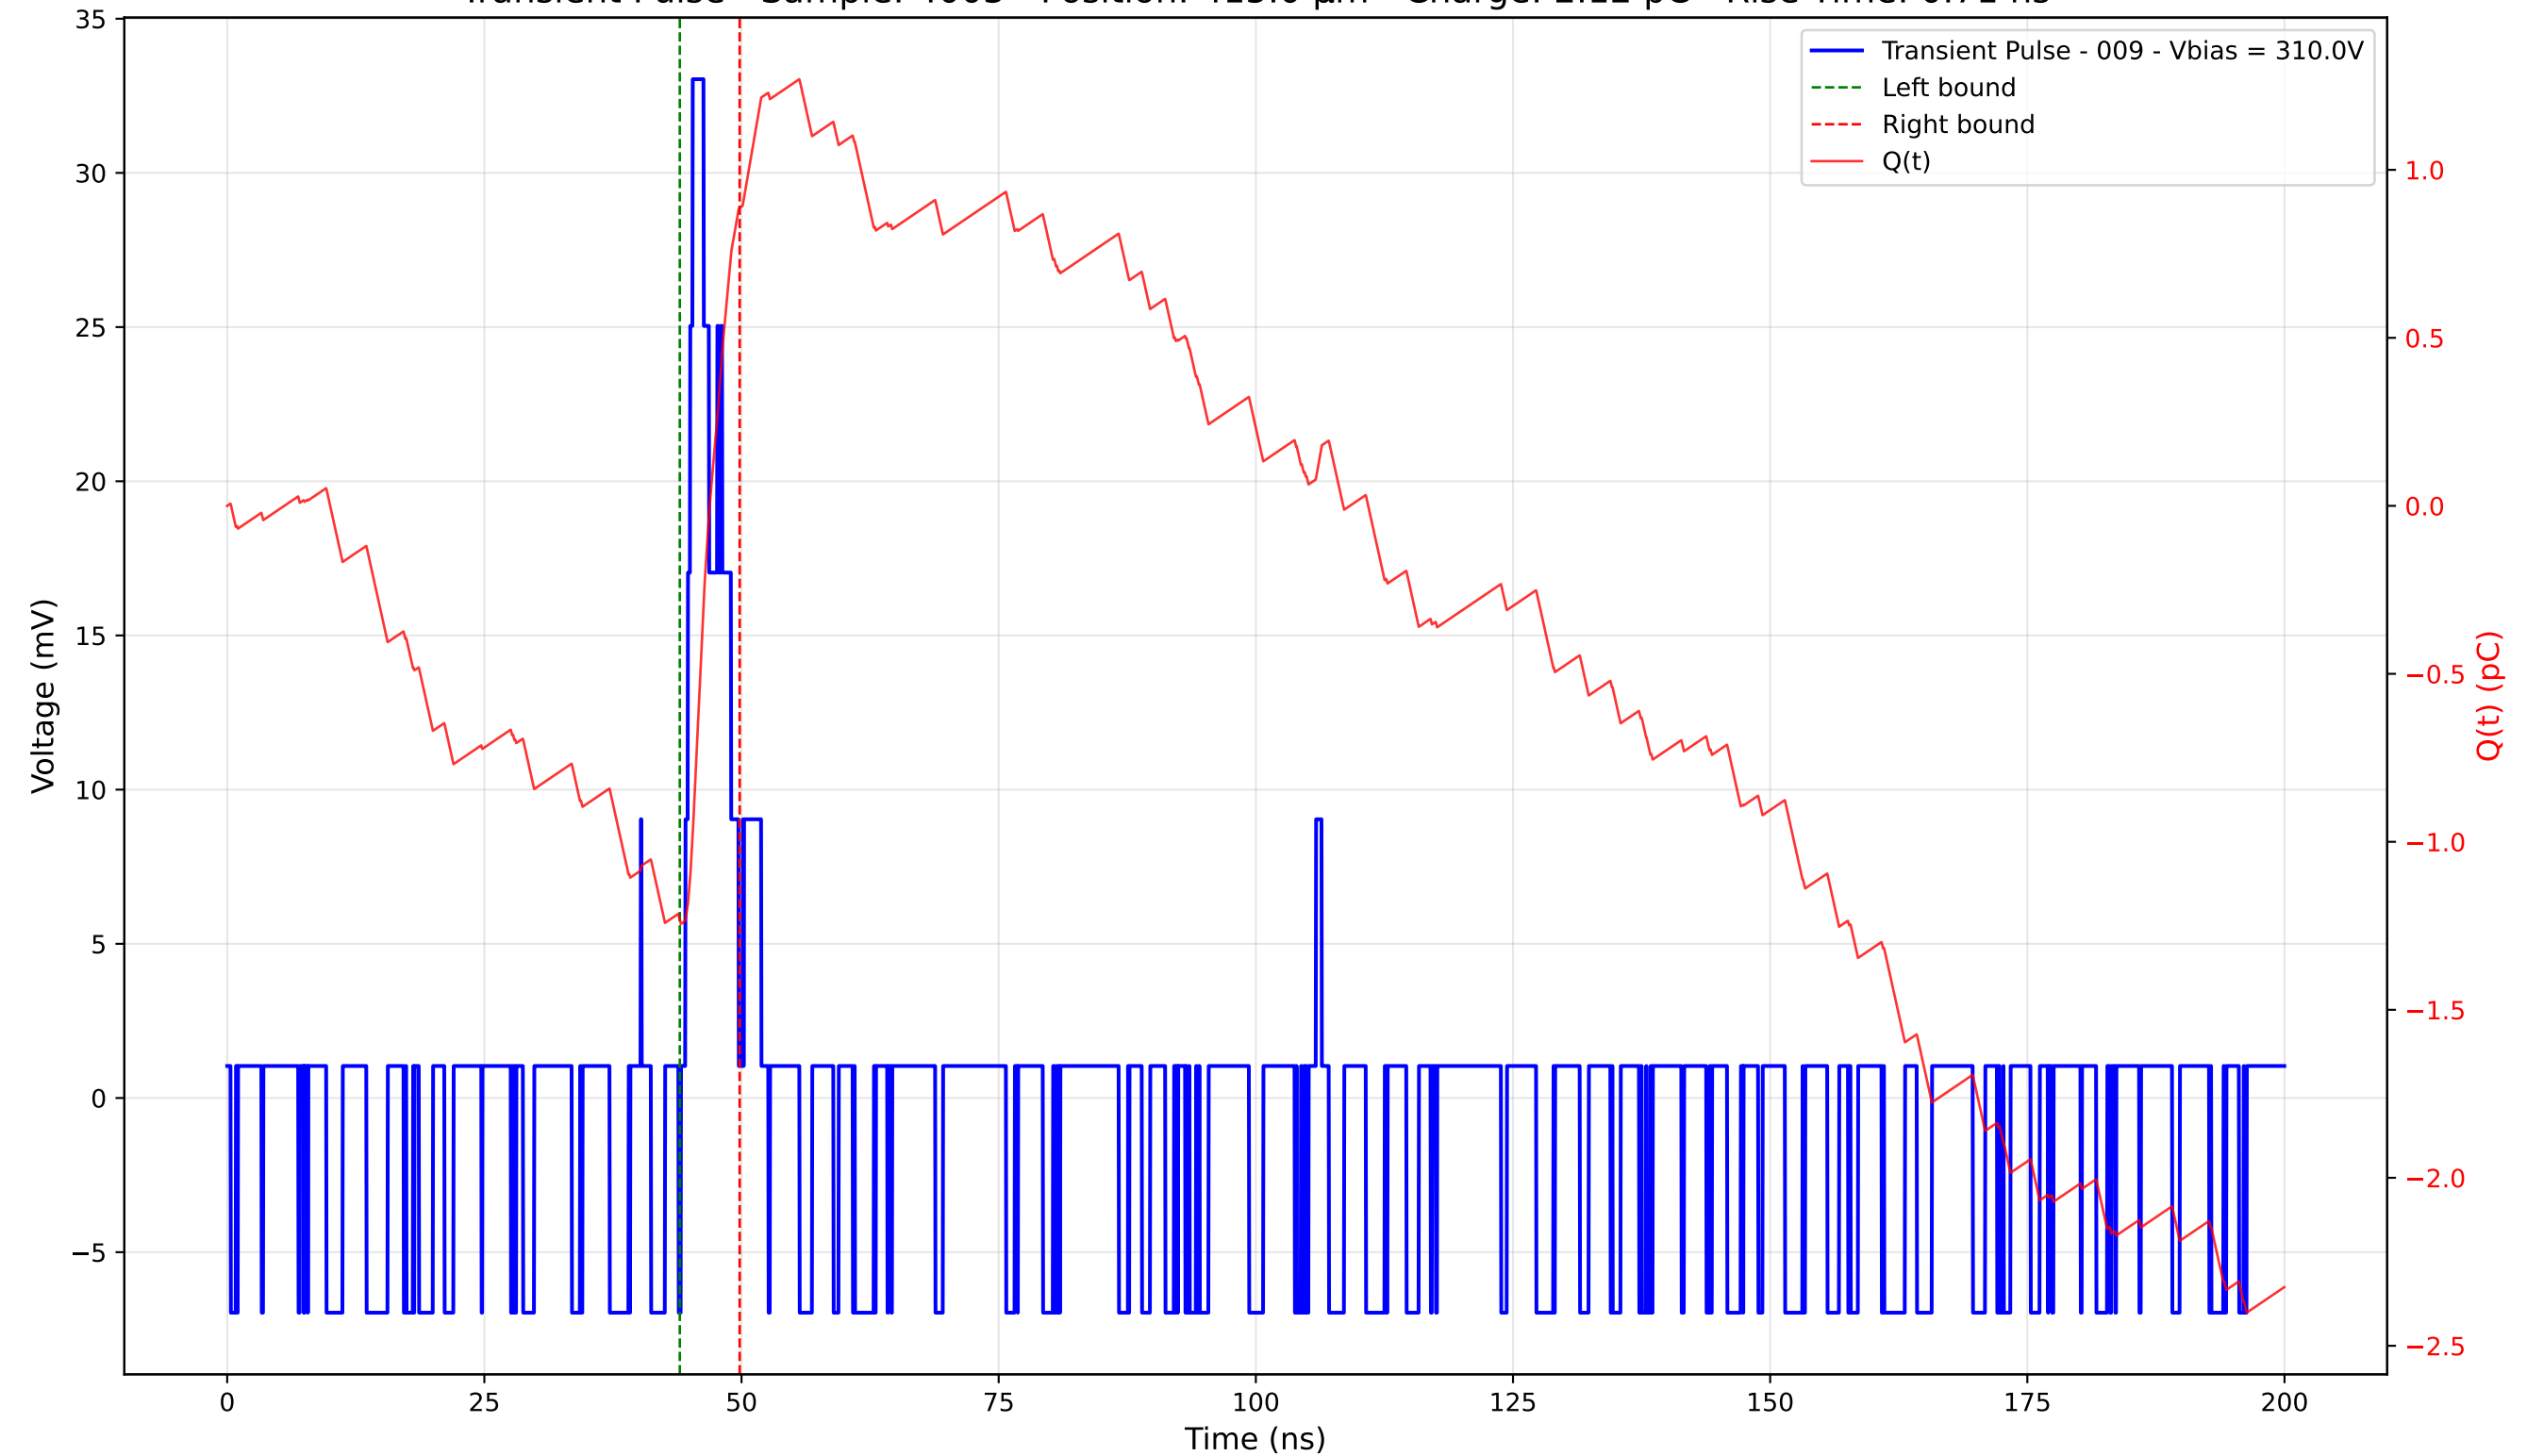

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 0.67 pC - Rise Time: 0.90 ns

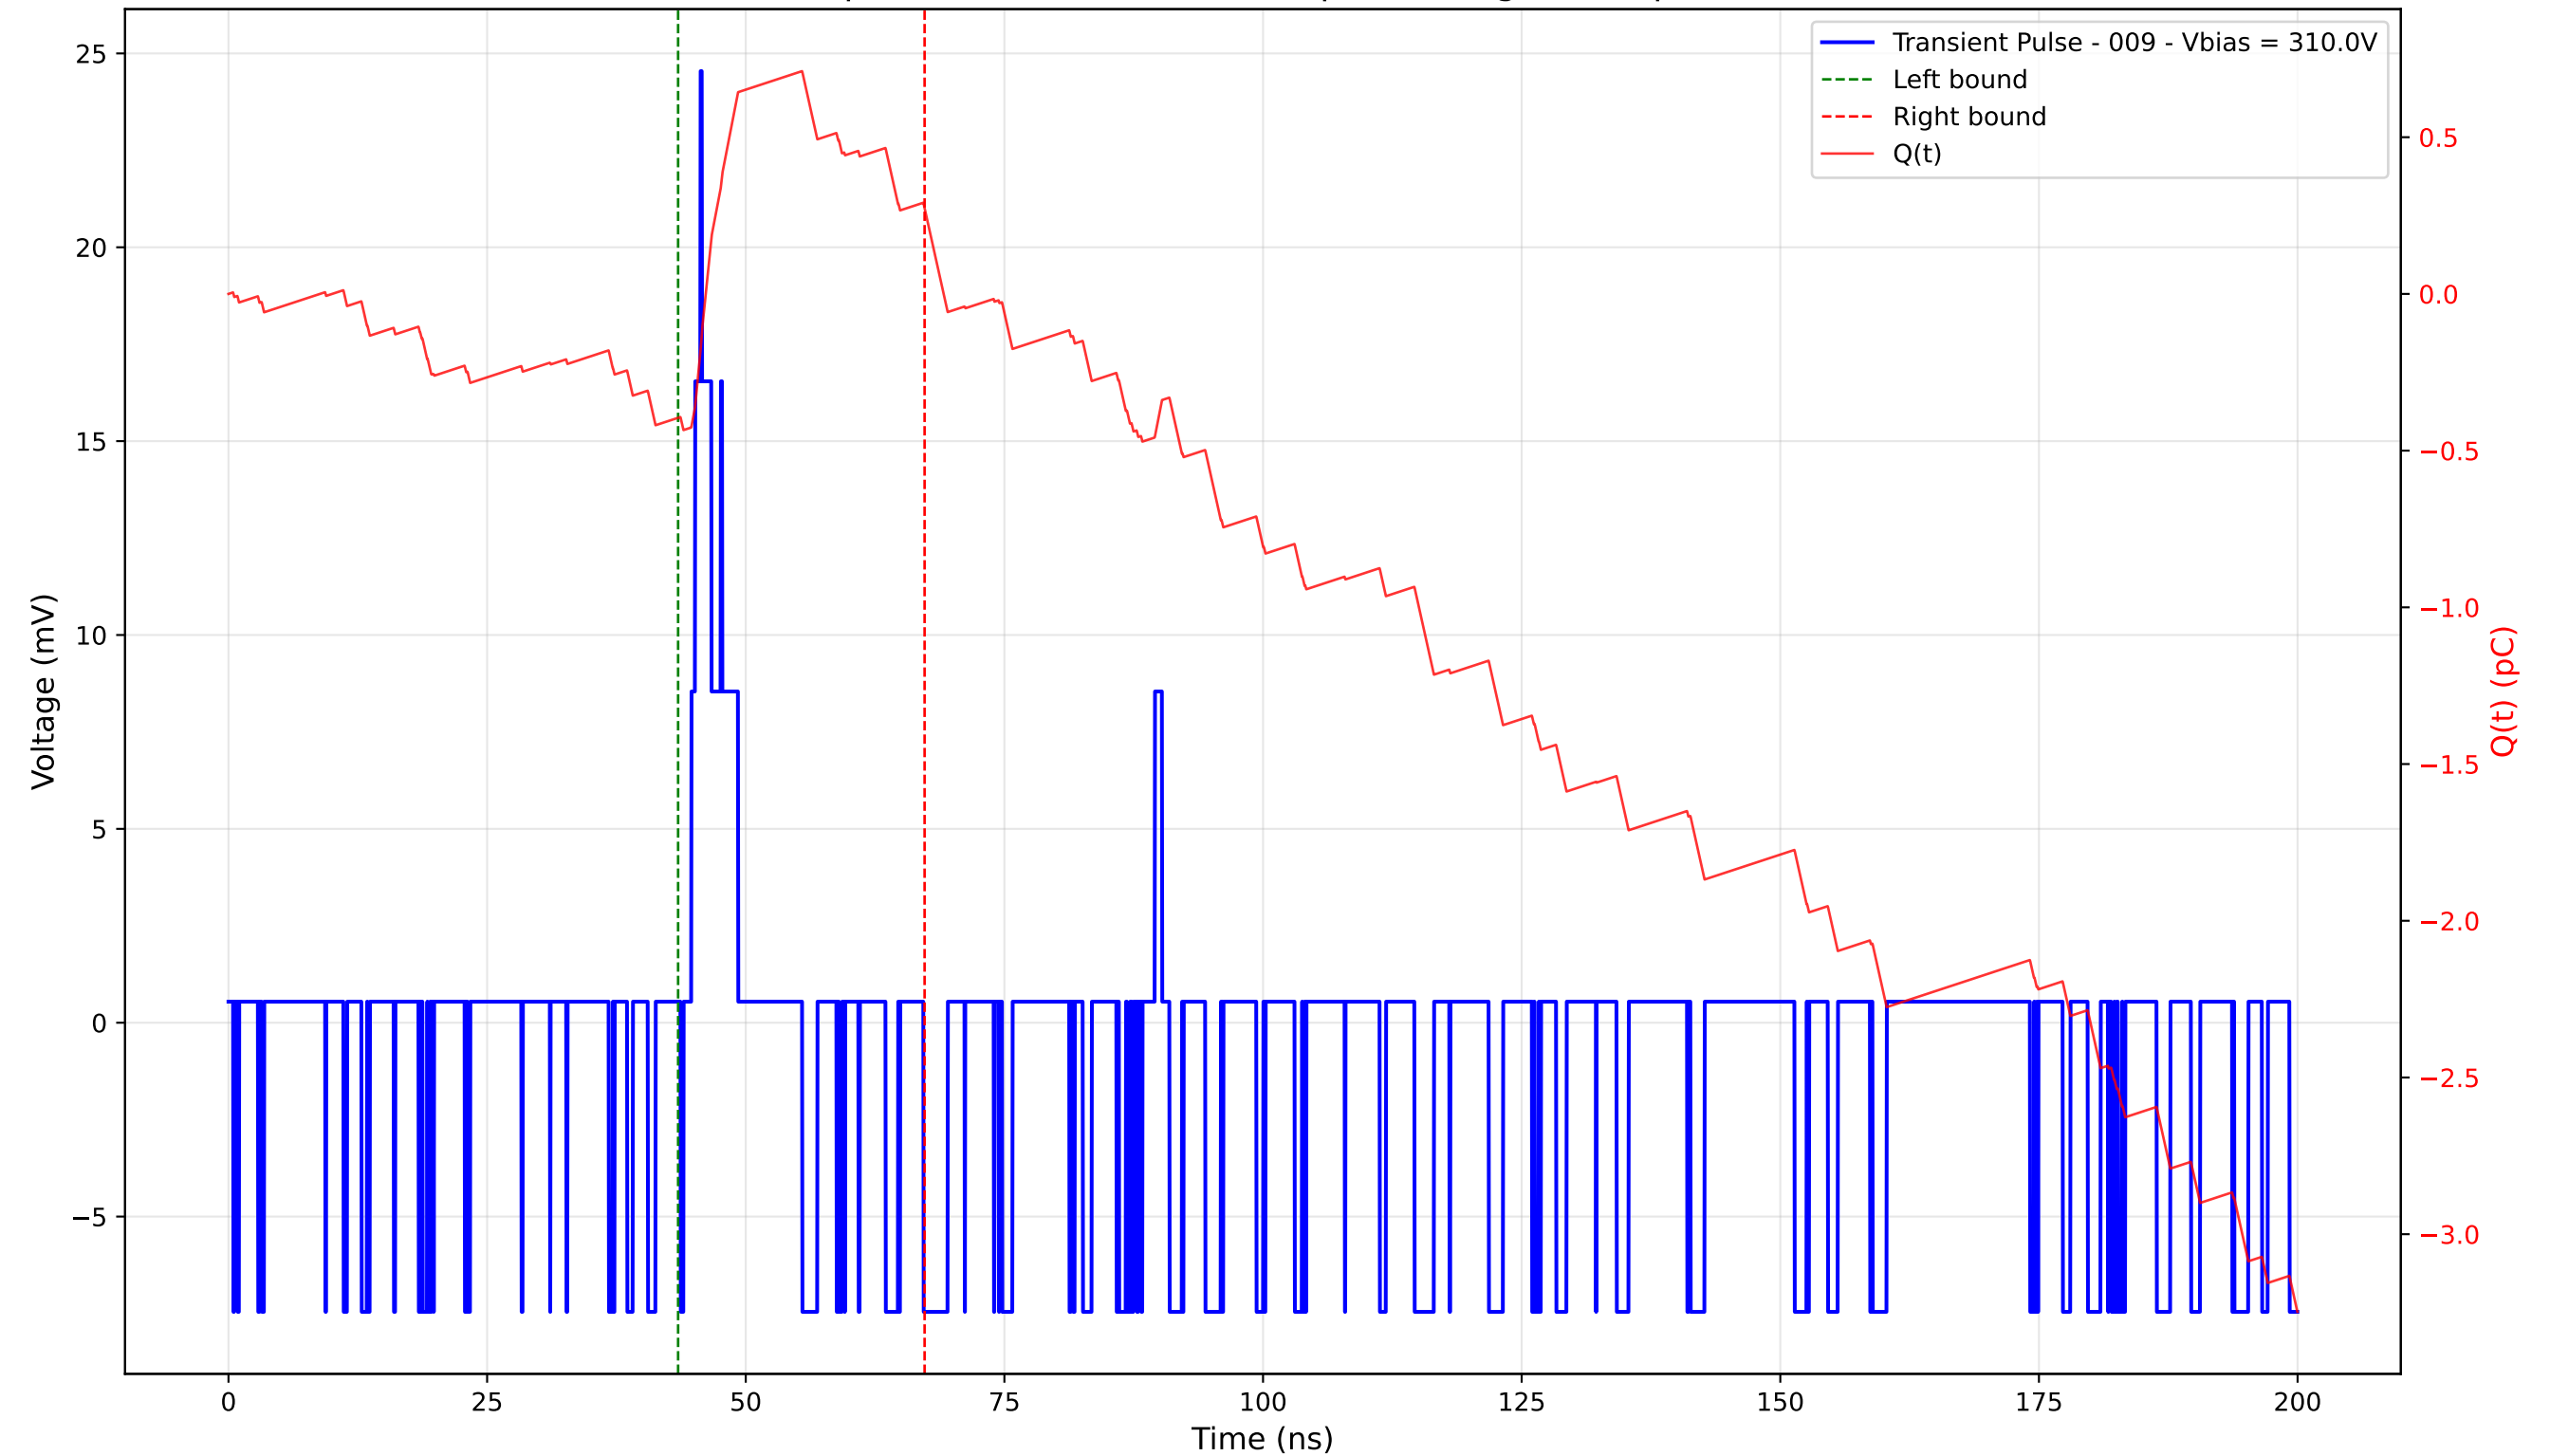

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.38 pC - Rise Time: 0.42 ns

