


TCT Run 010 Summary

Parameter	Value
Run	Run010
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	290.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\290V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

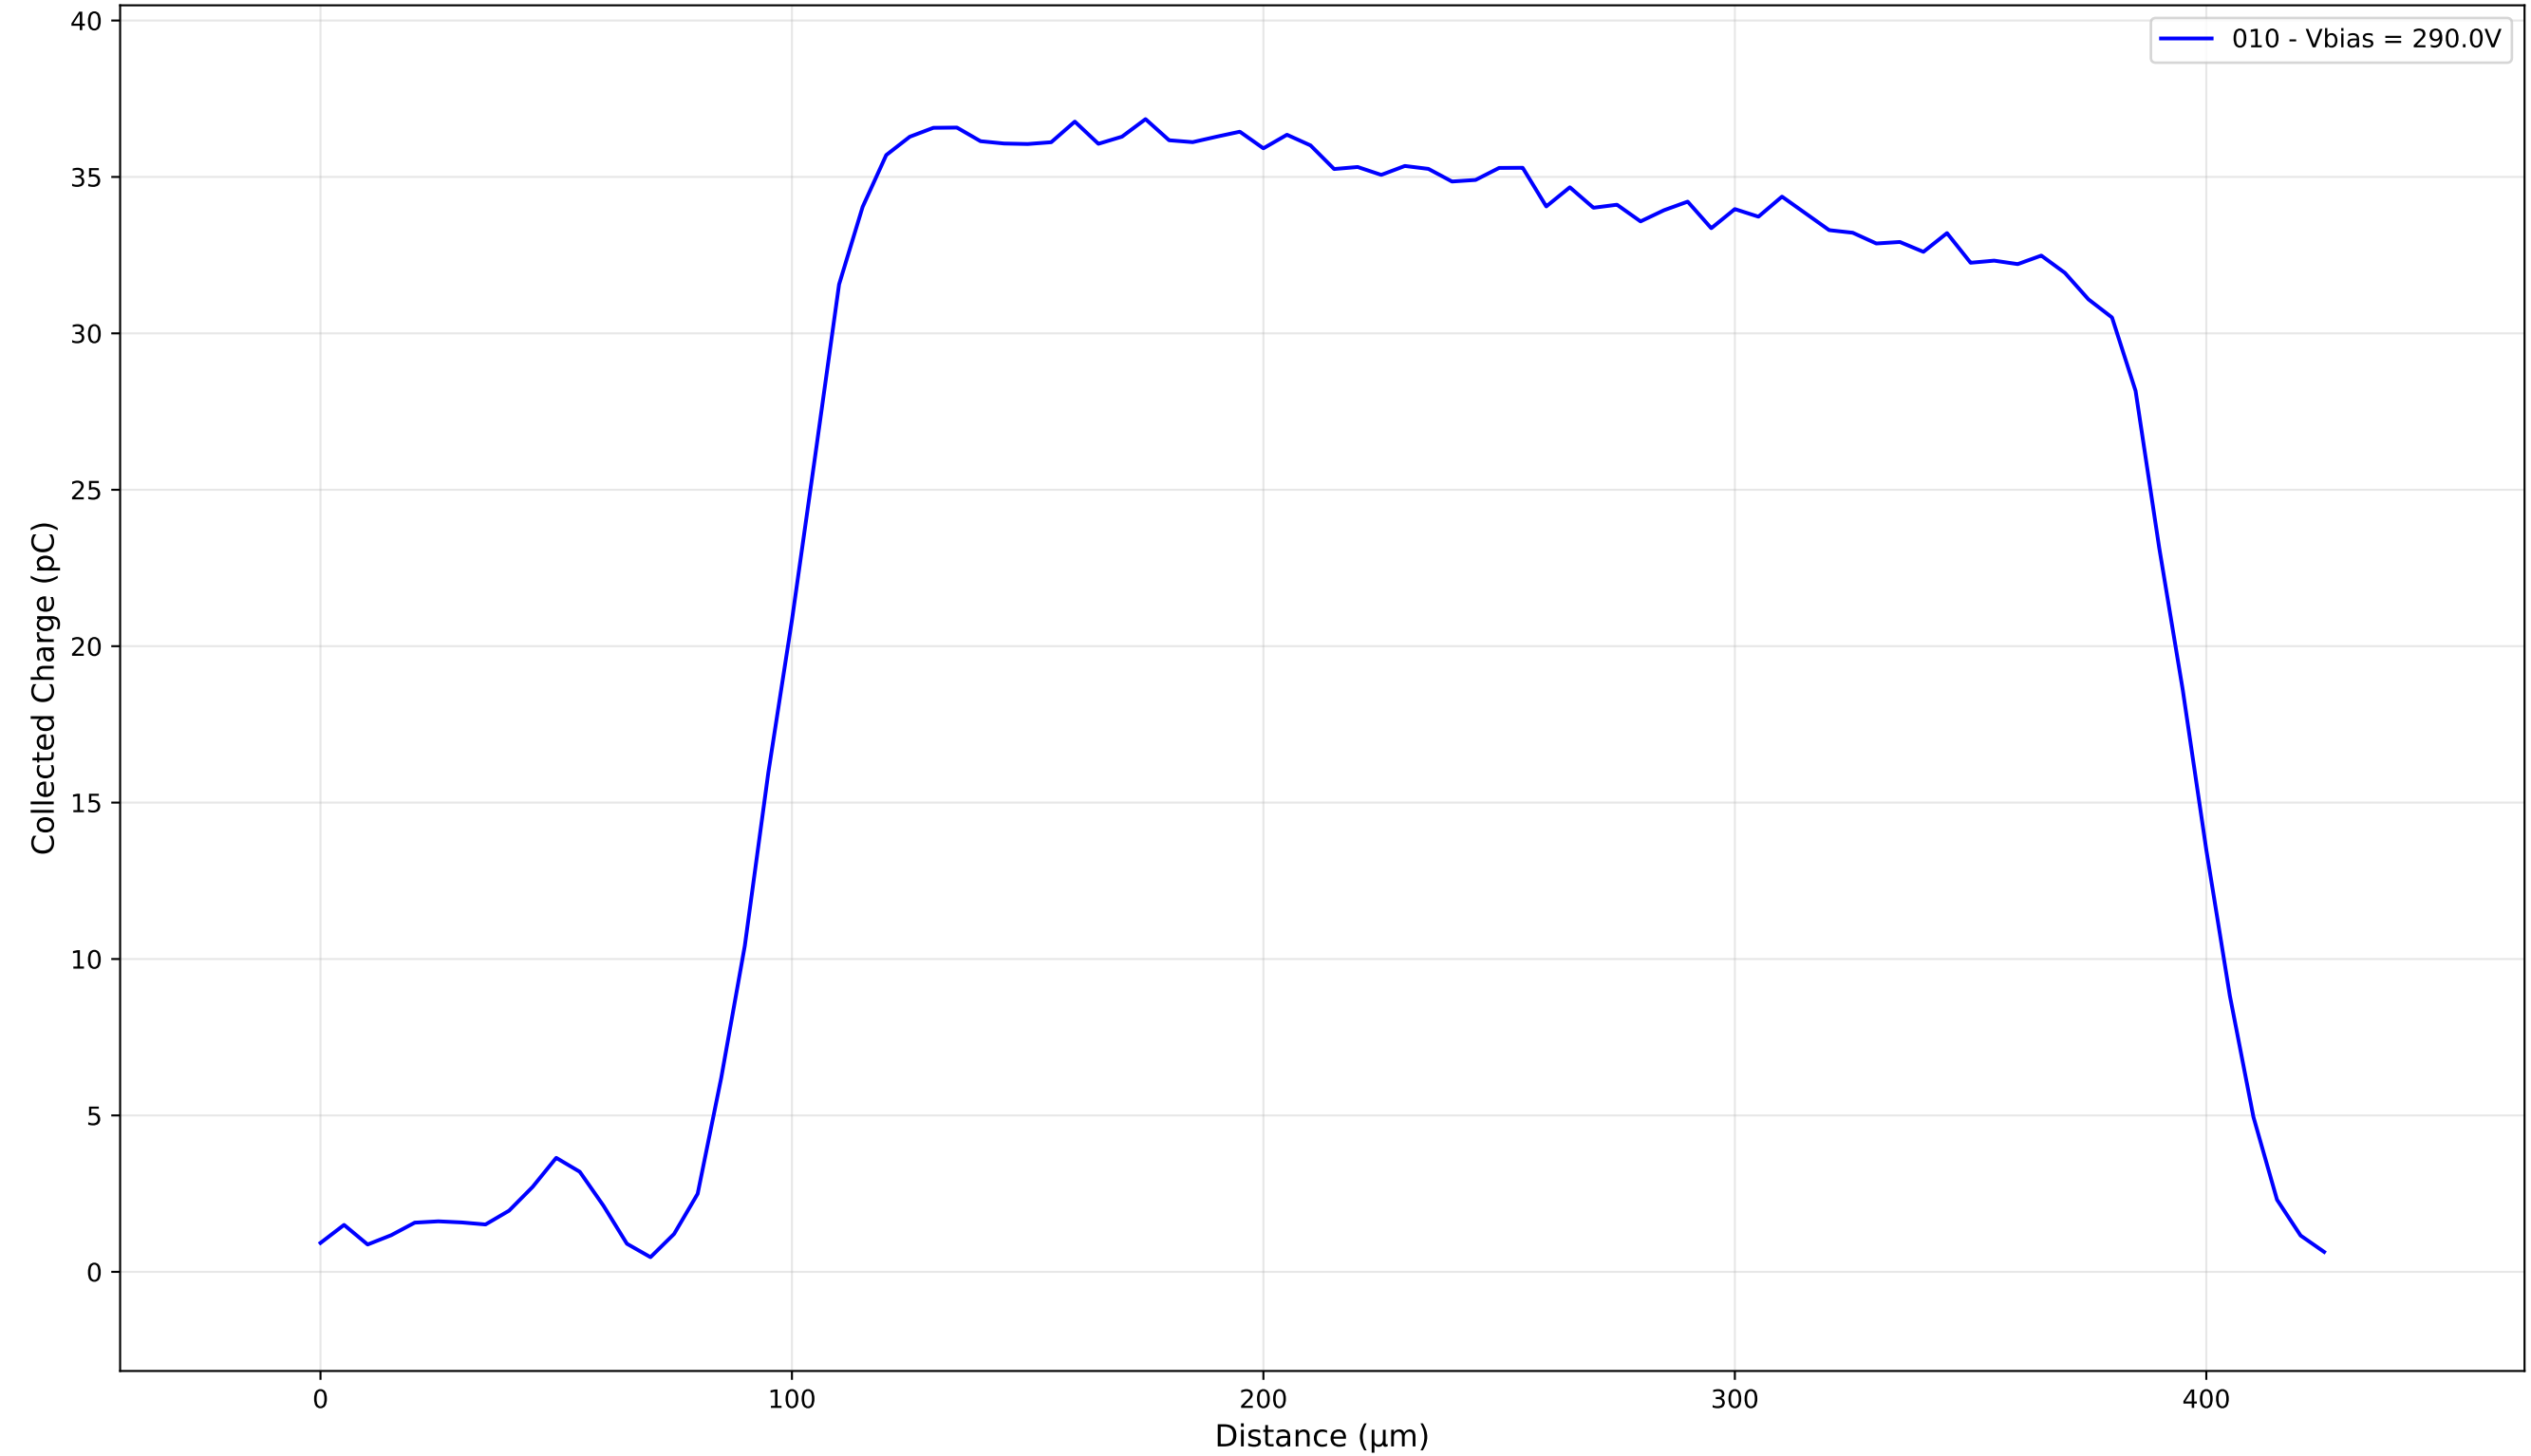

Collected Charge

010 - Vbias = 290.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

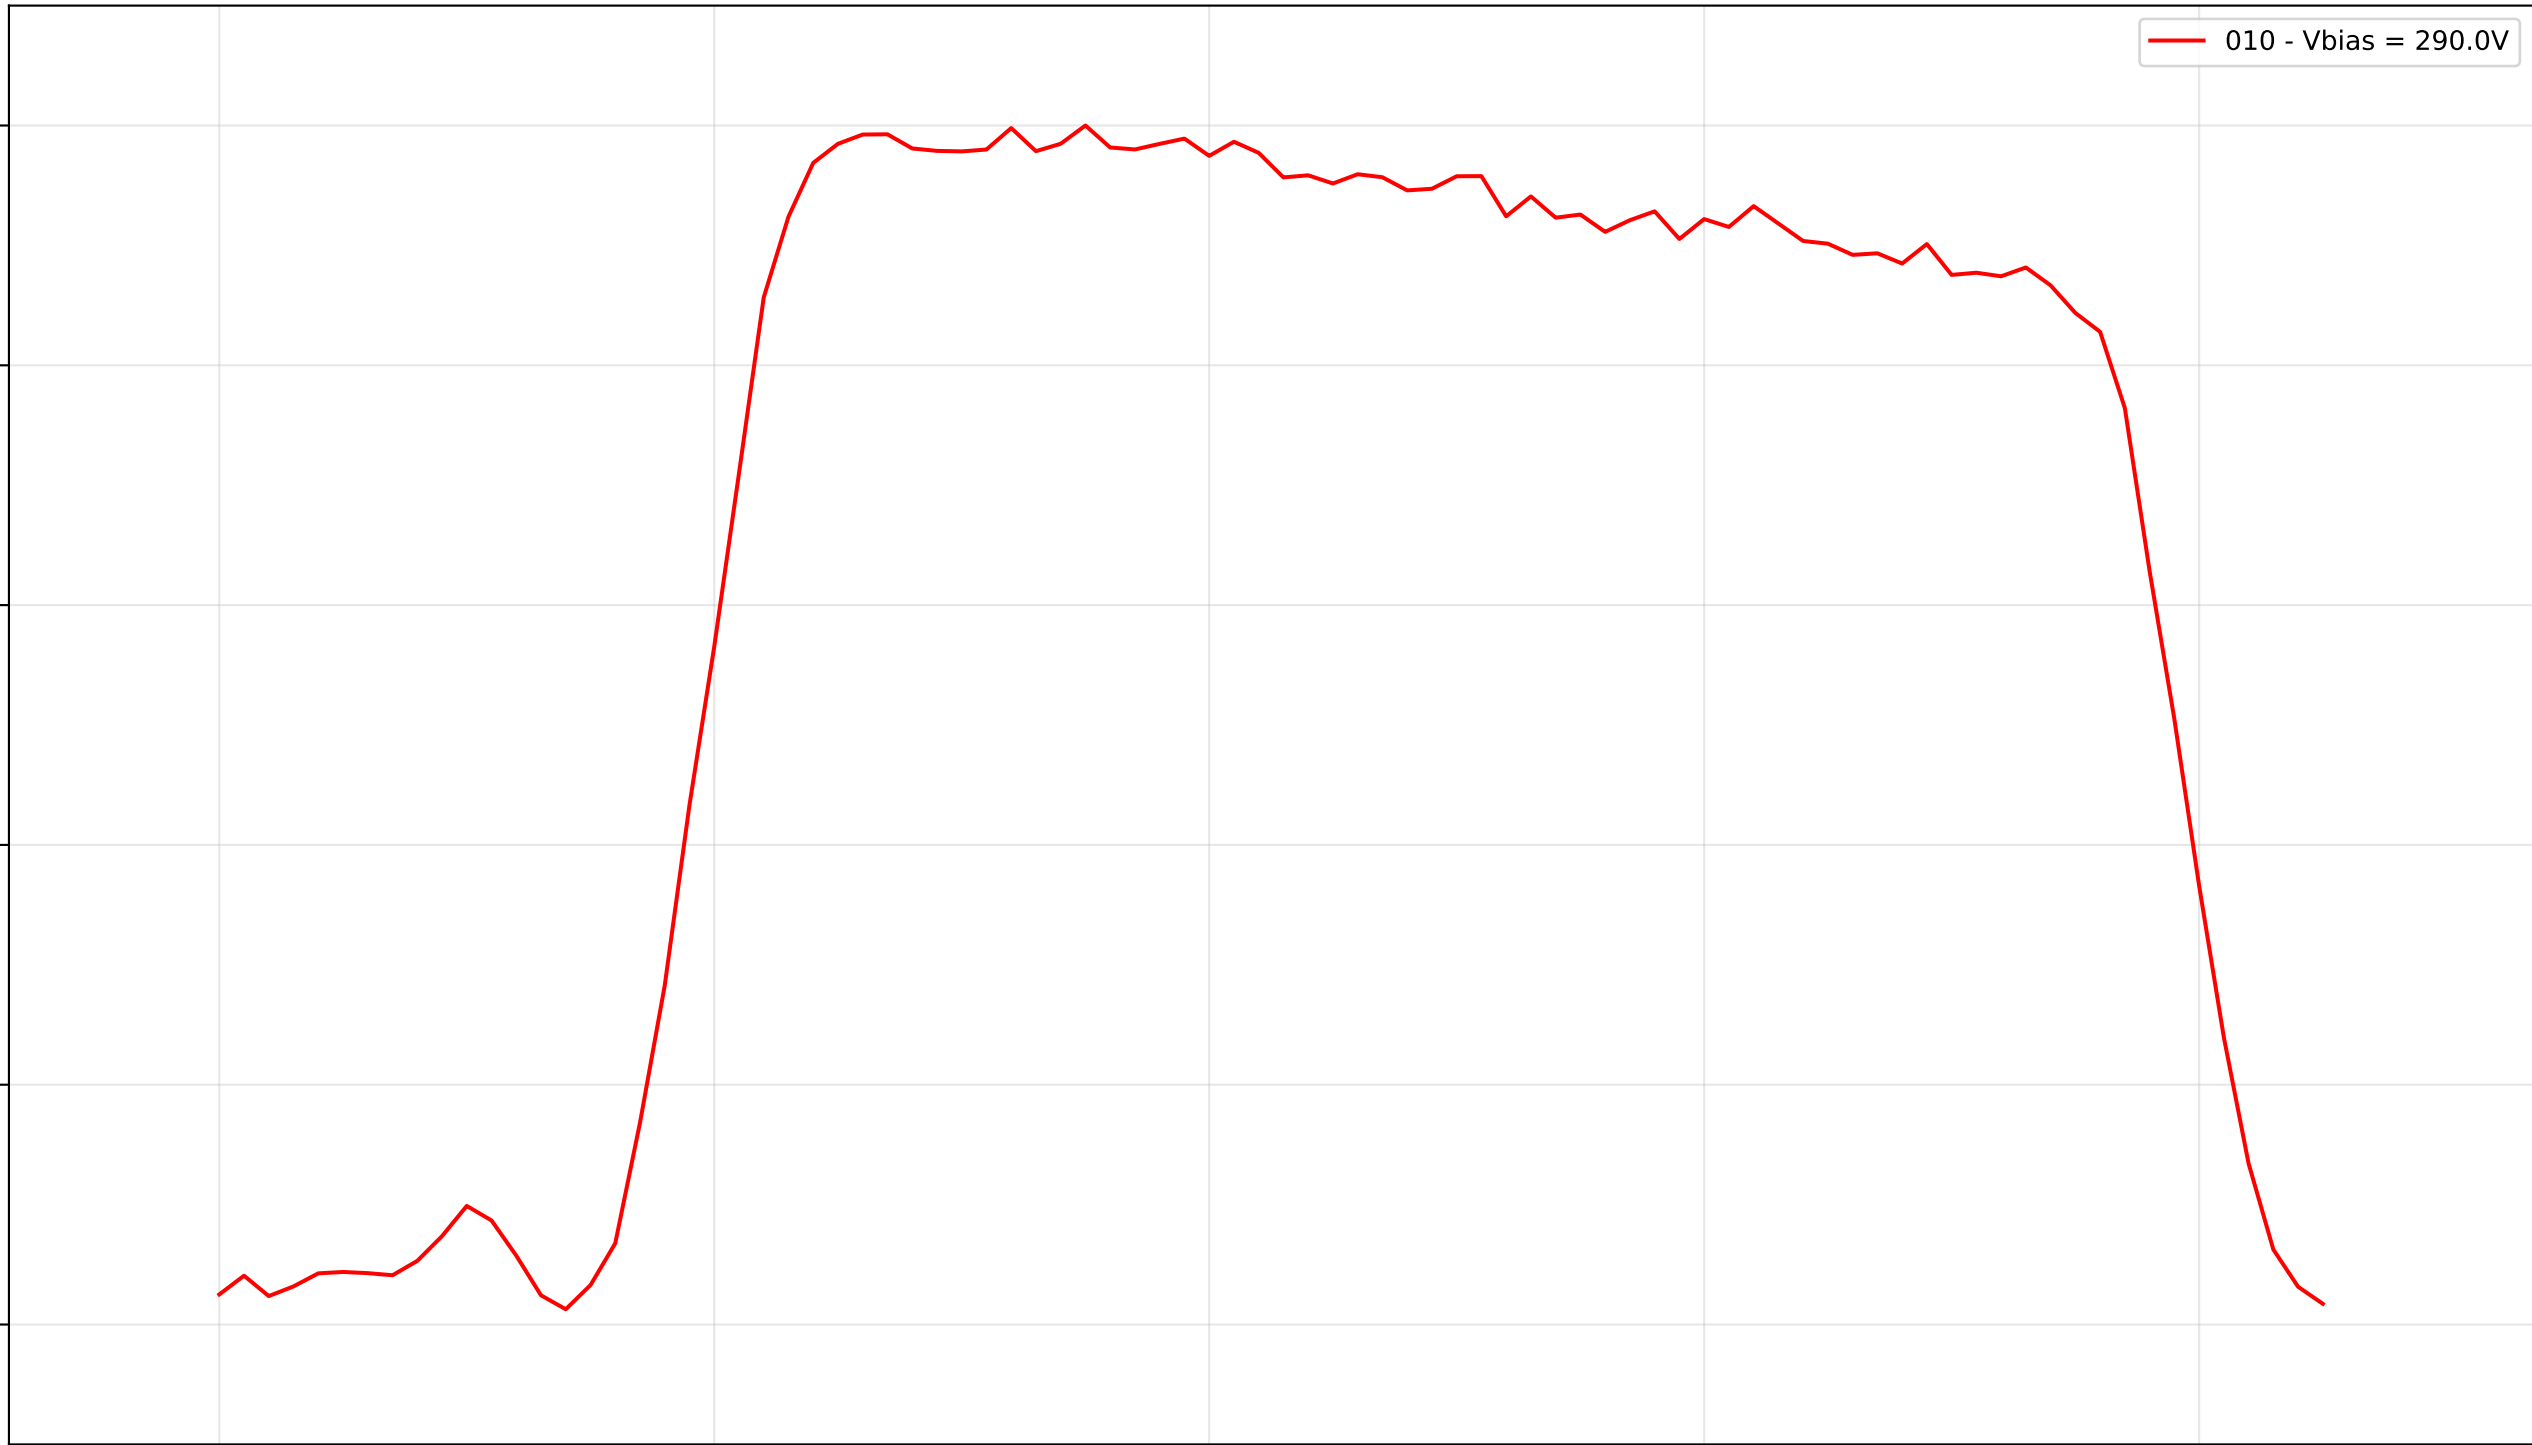


Rise Time

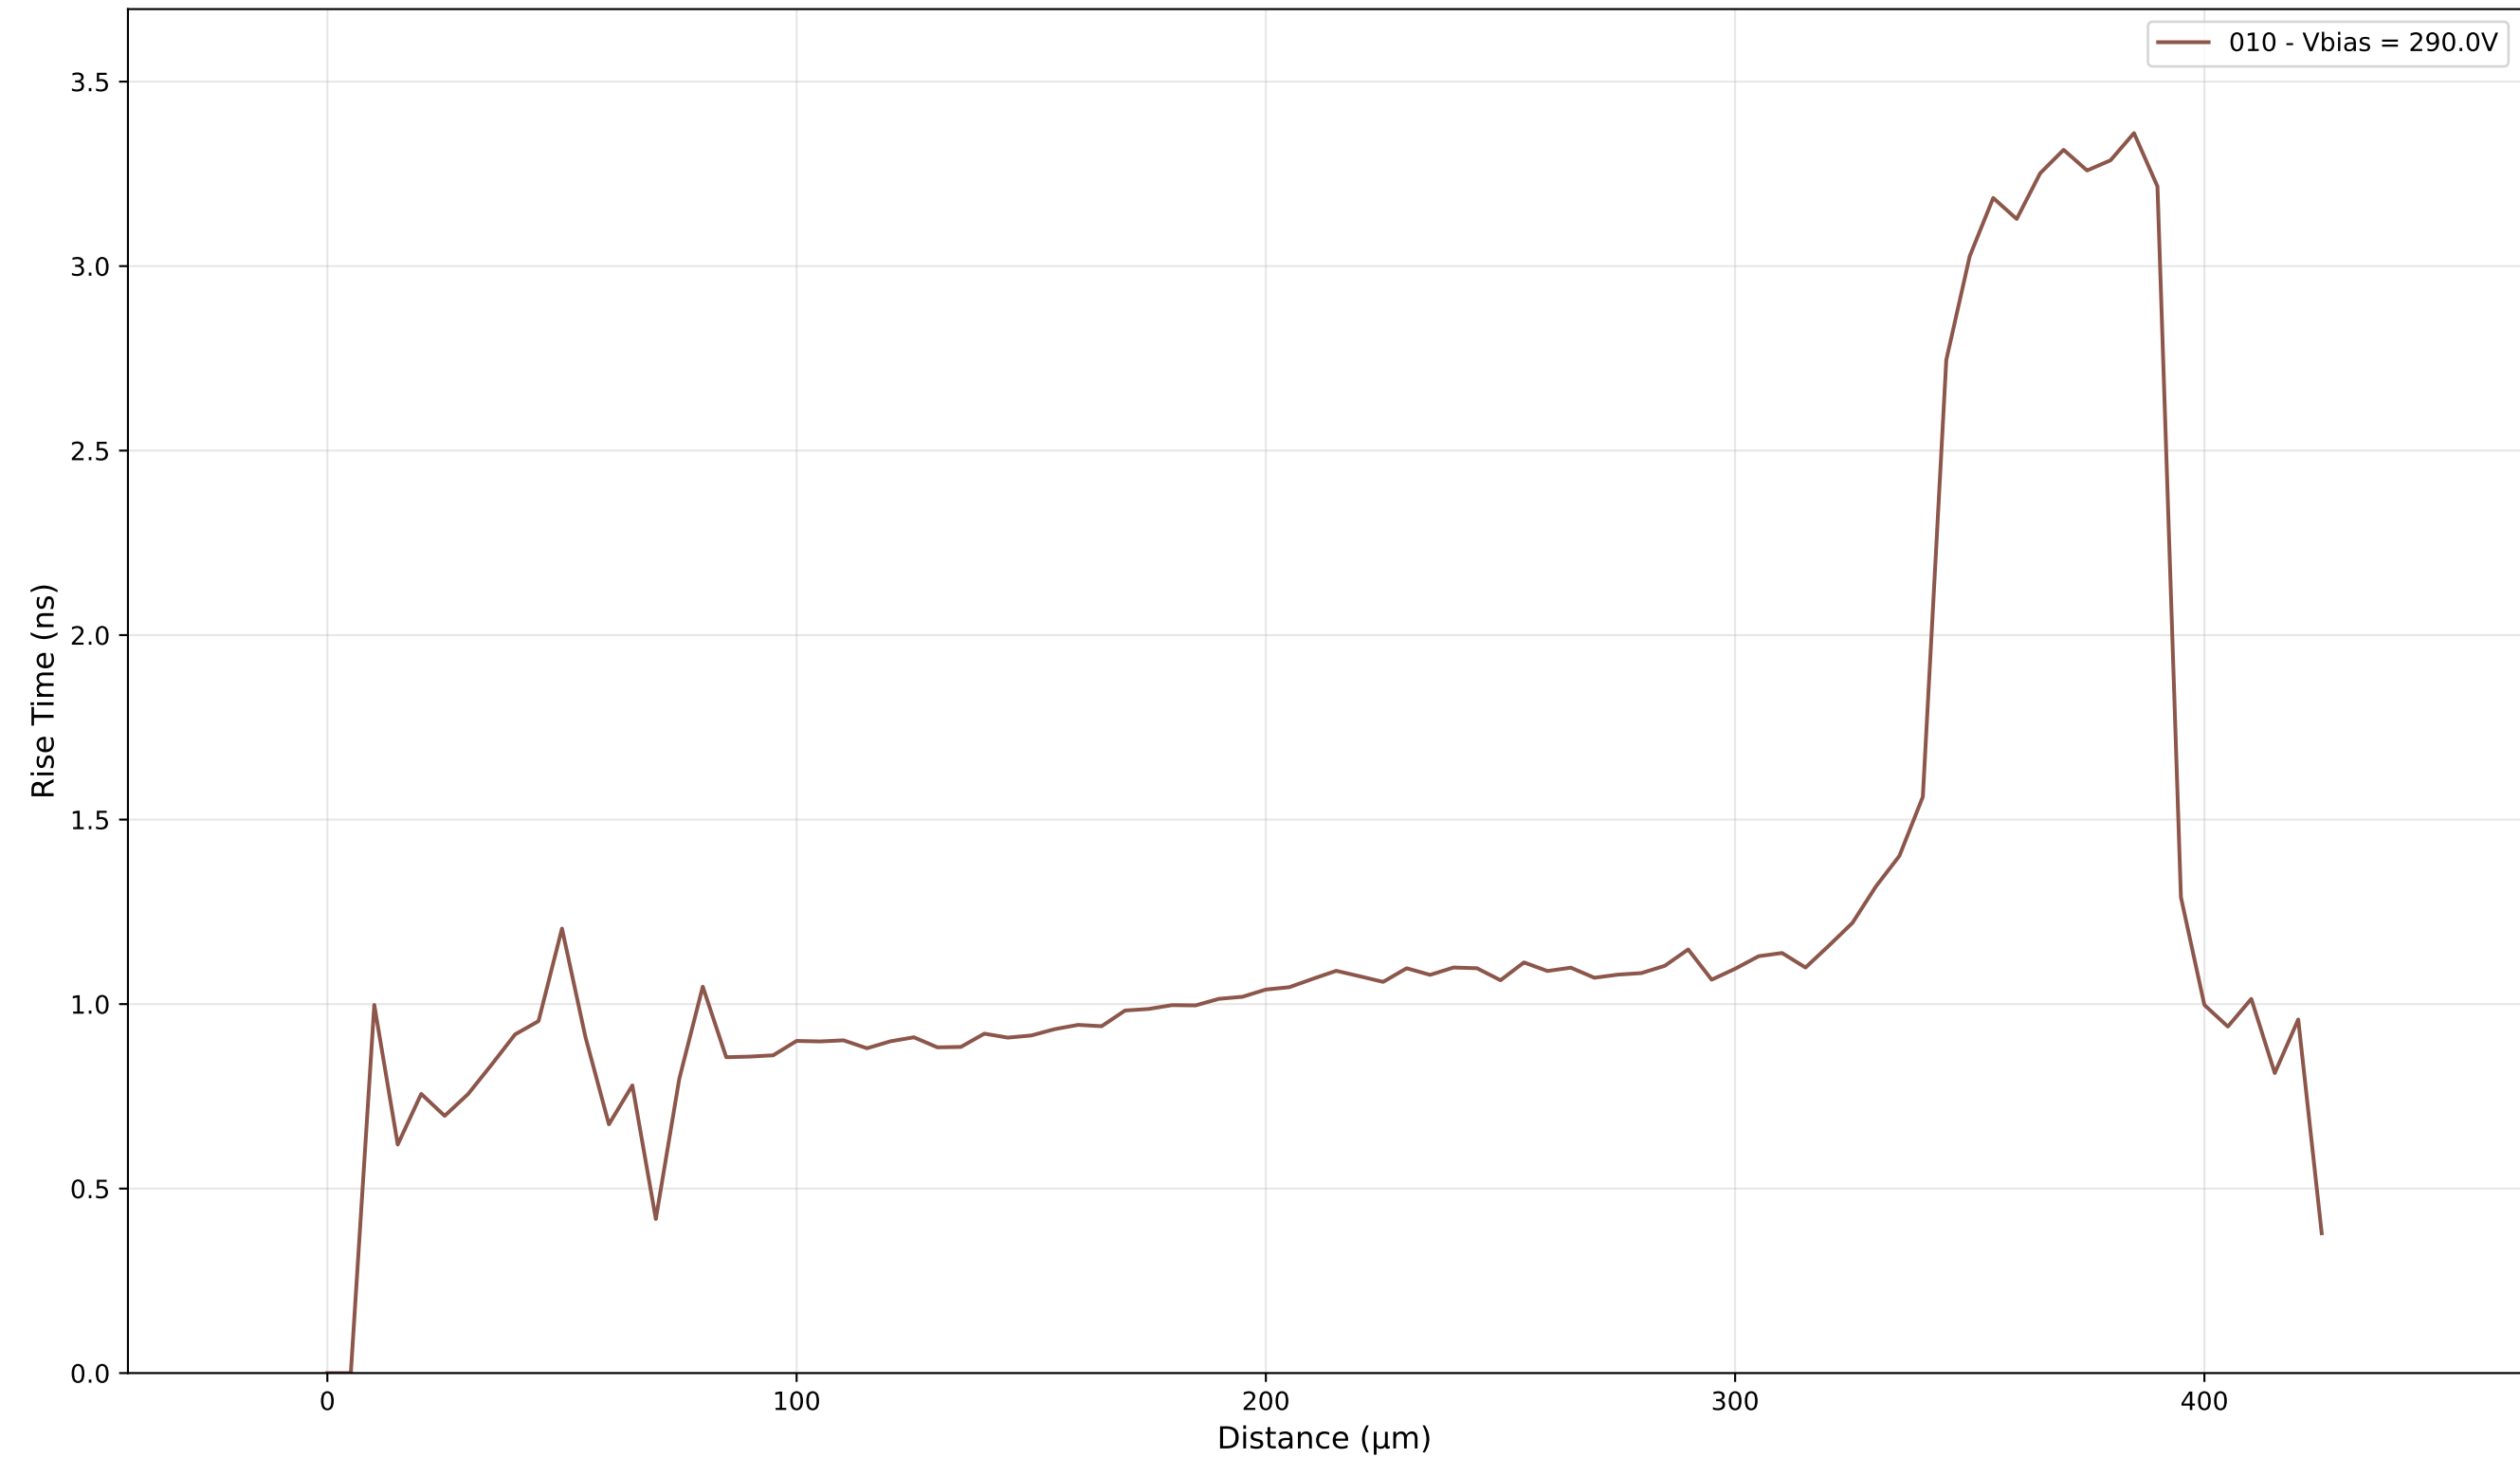


Amplitude

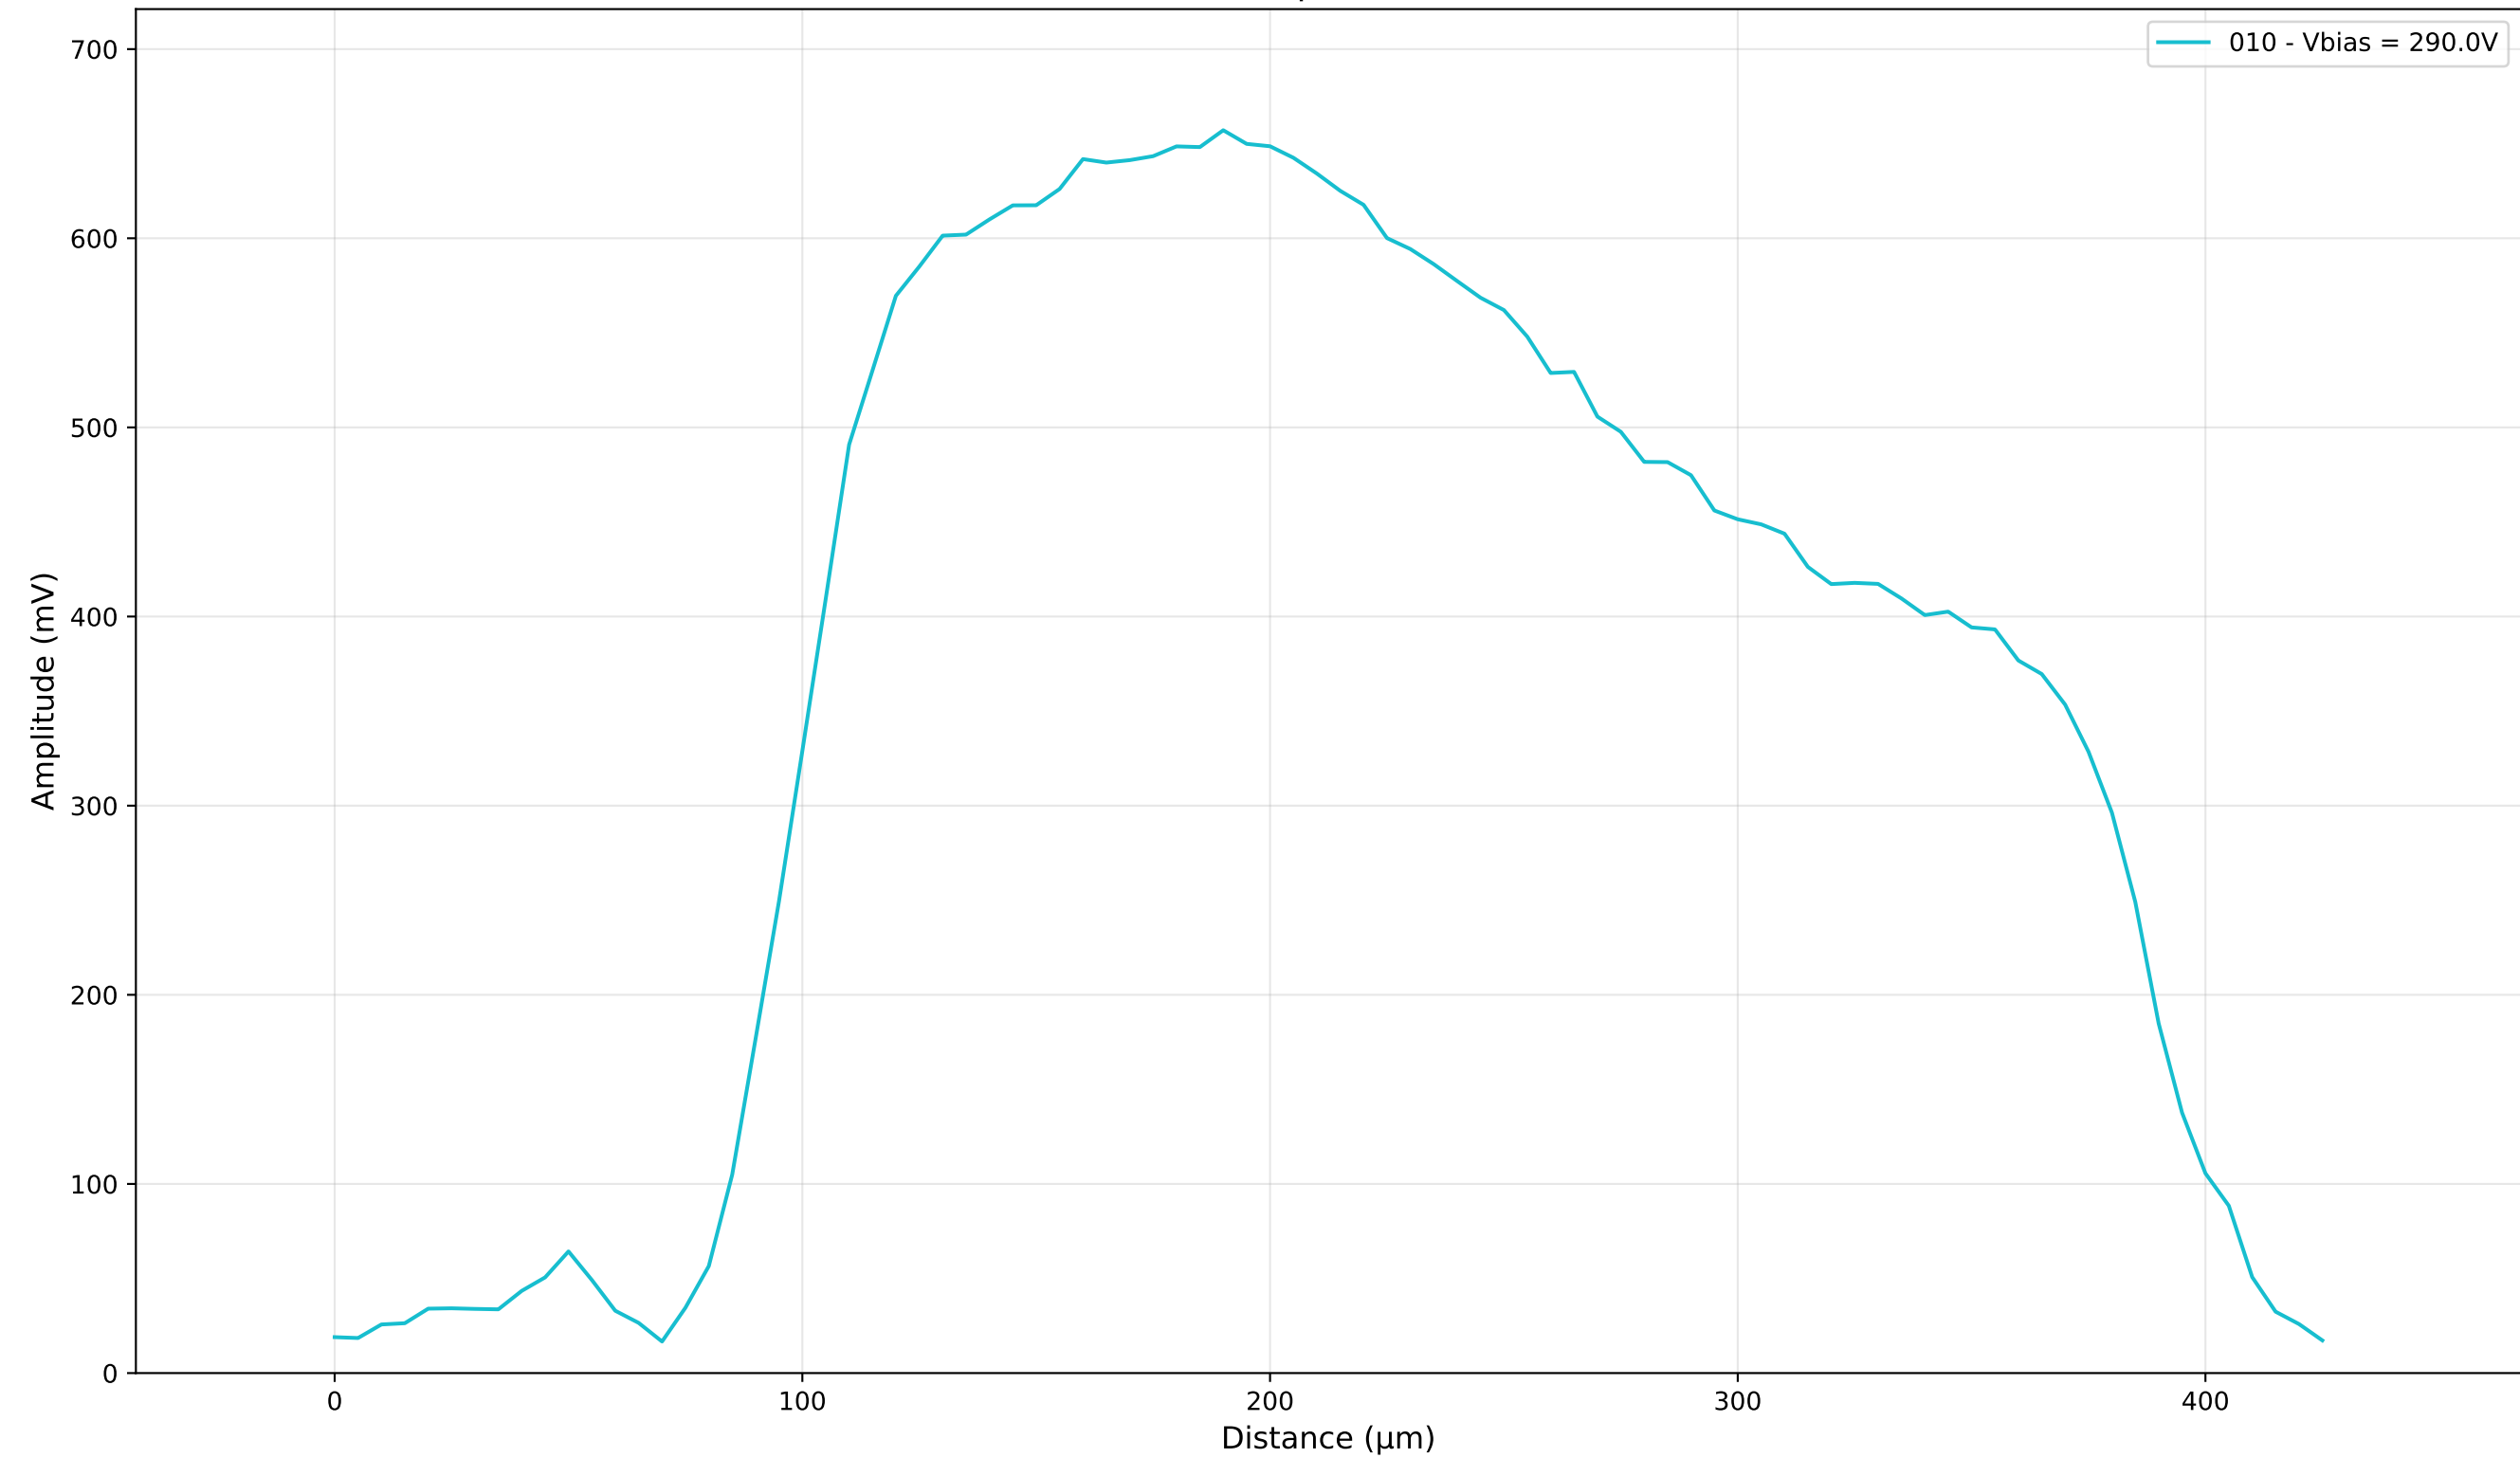


FWHM

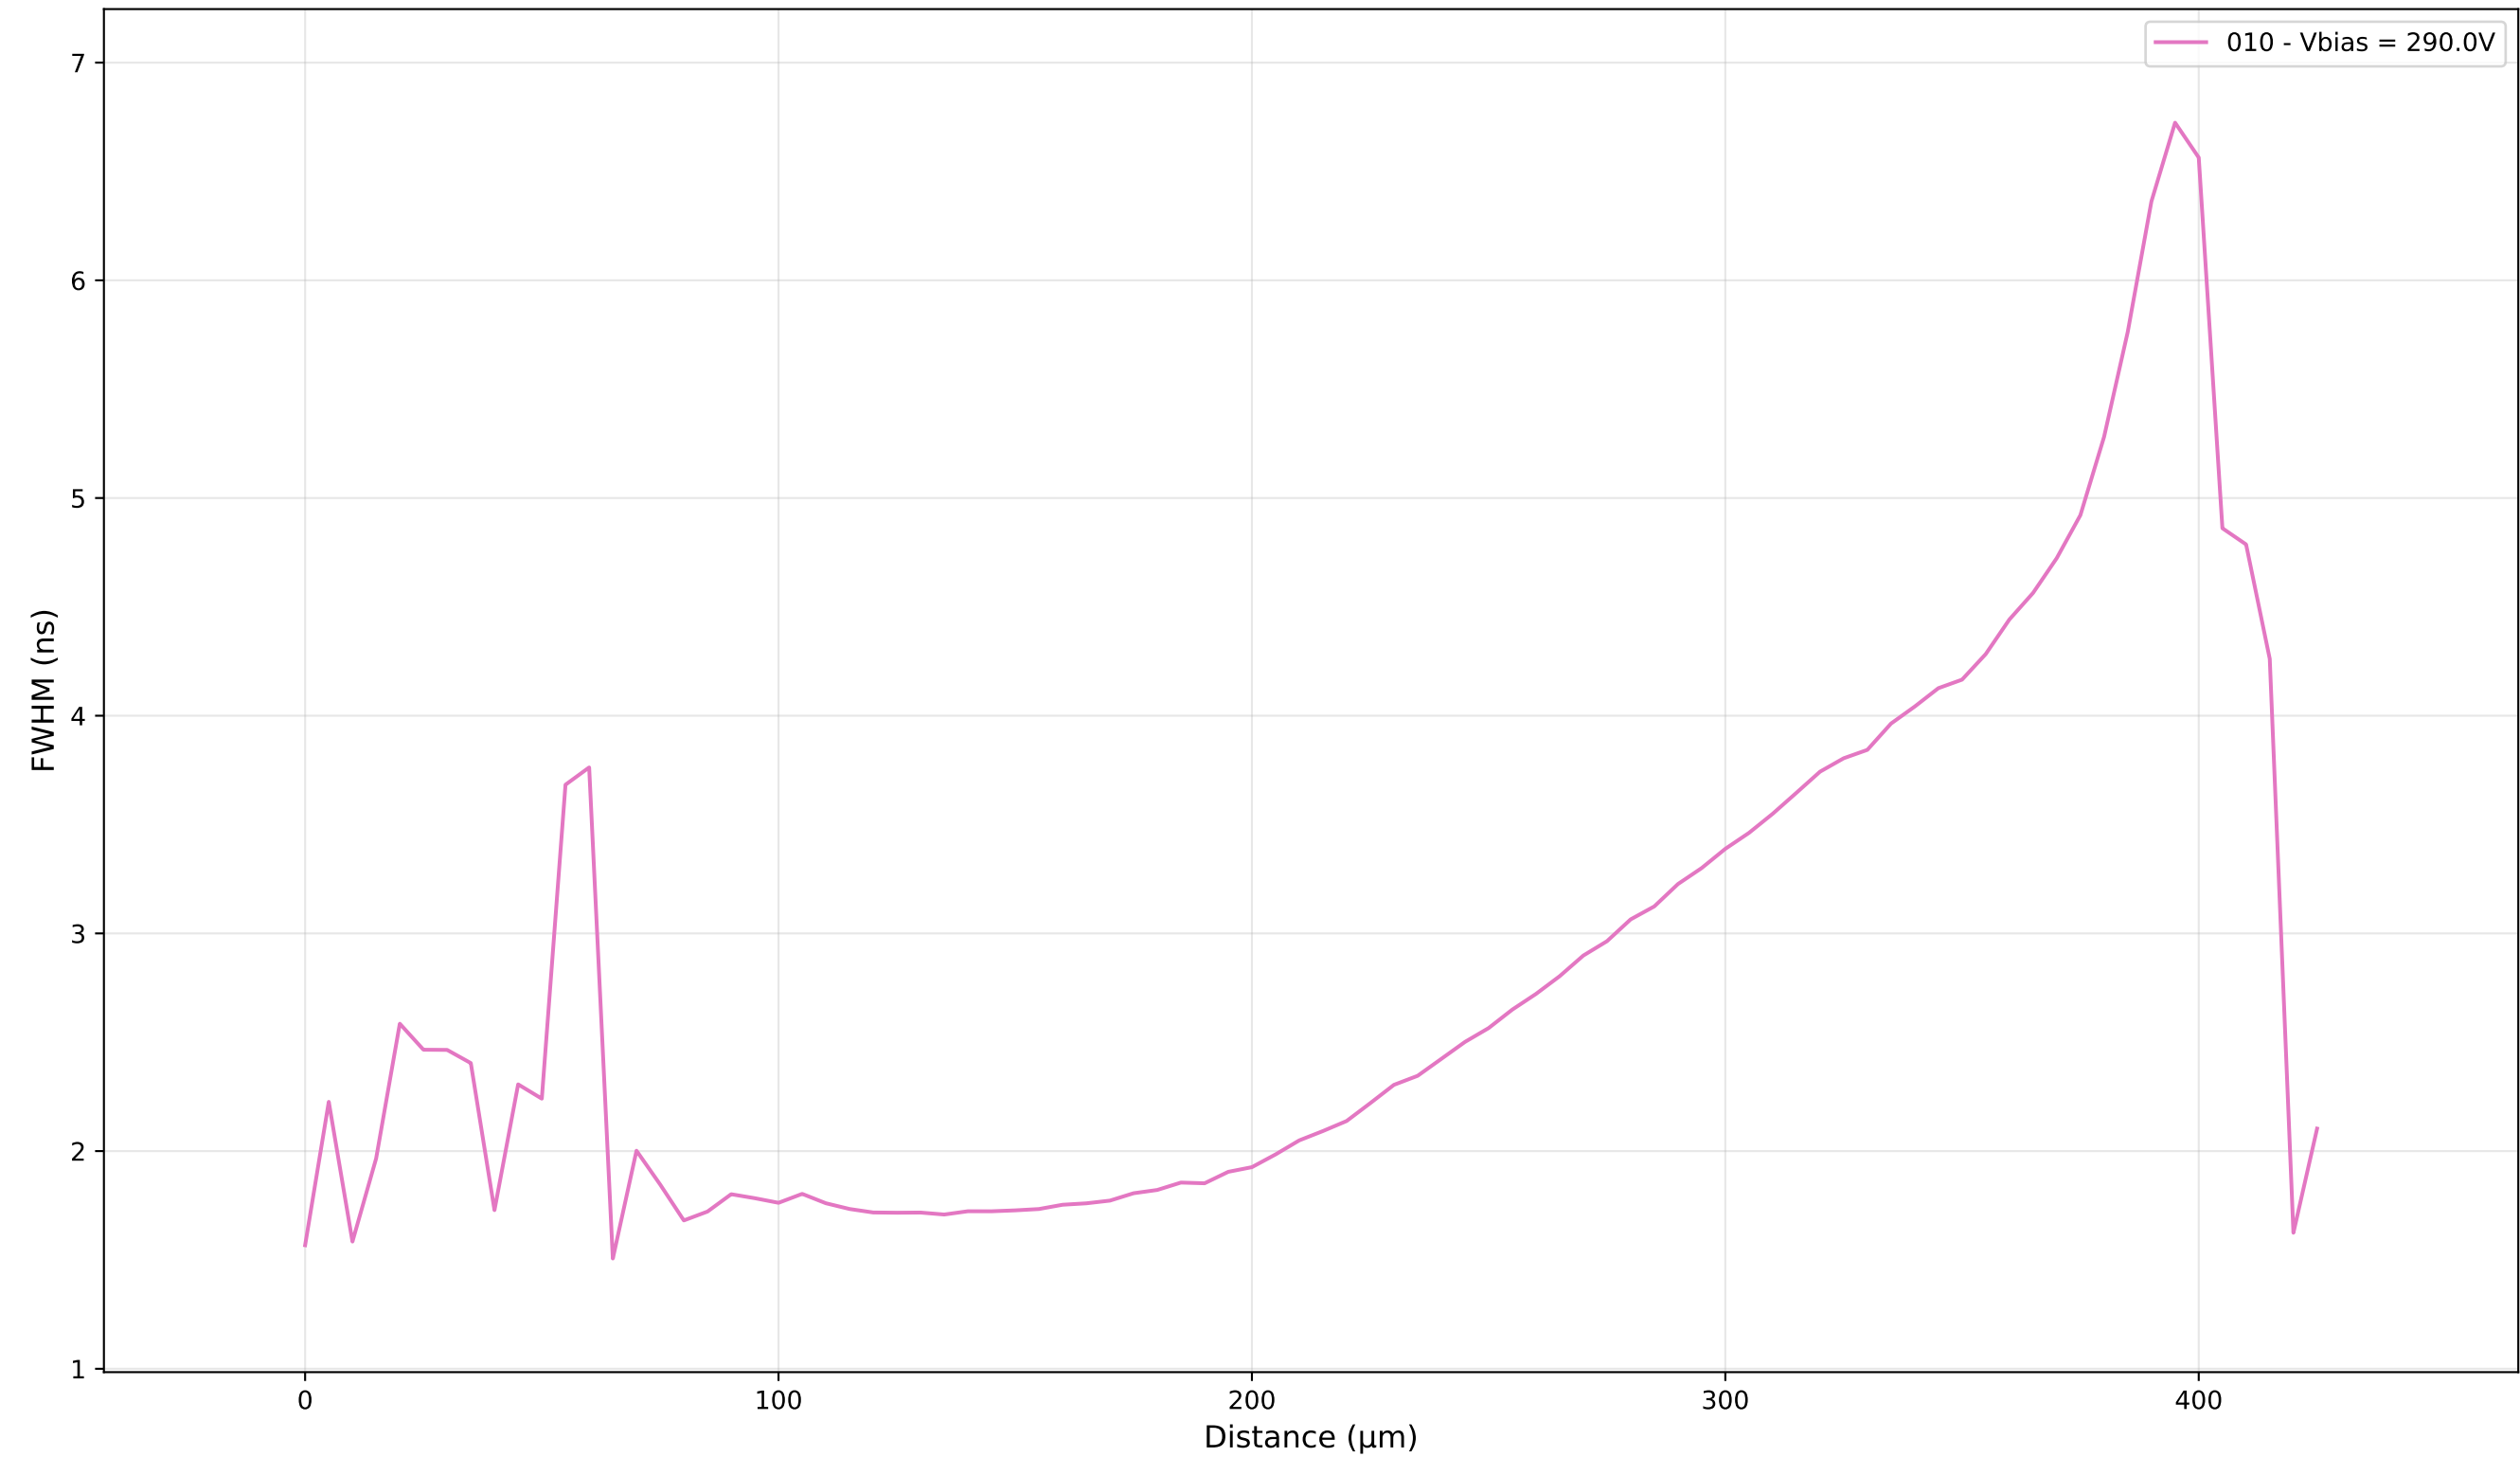


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.92 pC - Rise Time: 0.00 ns (N/A)

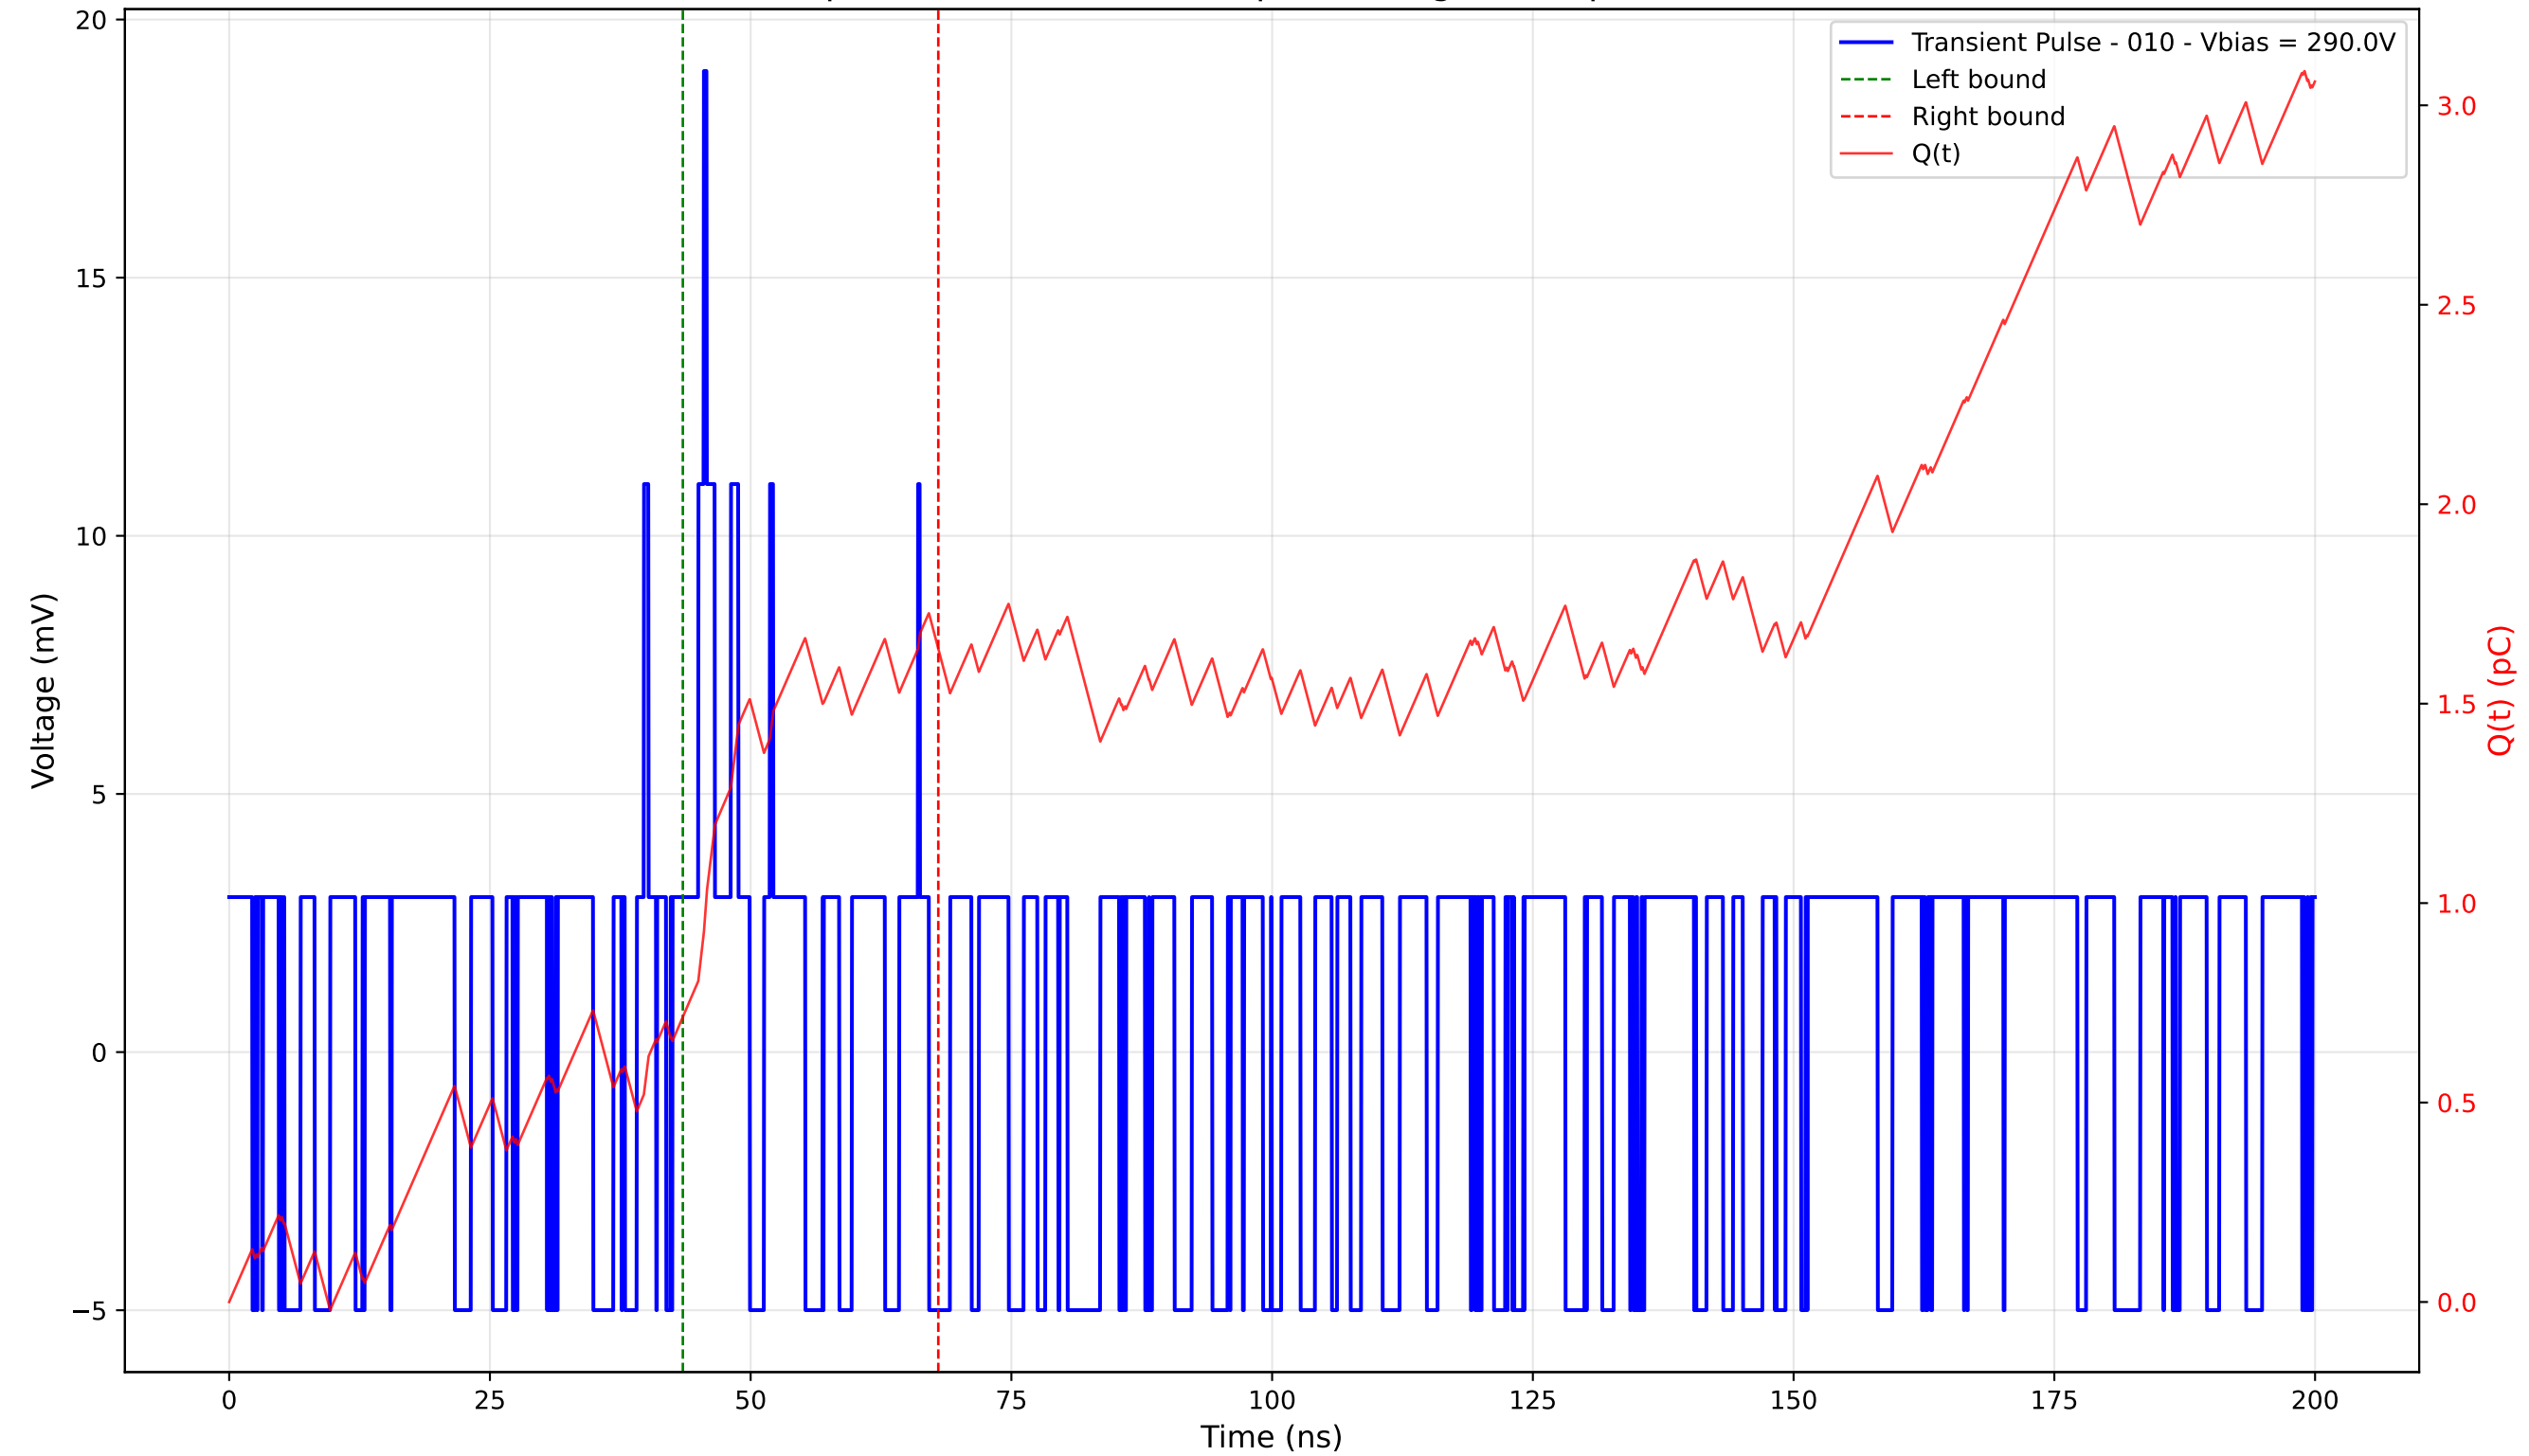


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 1.50 pC - Rise Time: 0.00 ns (N/A)

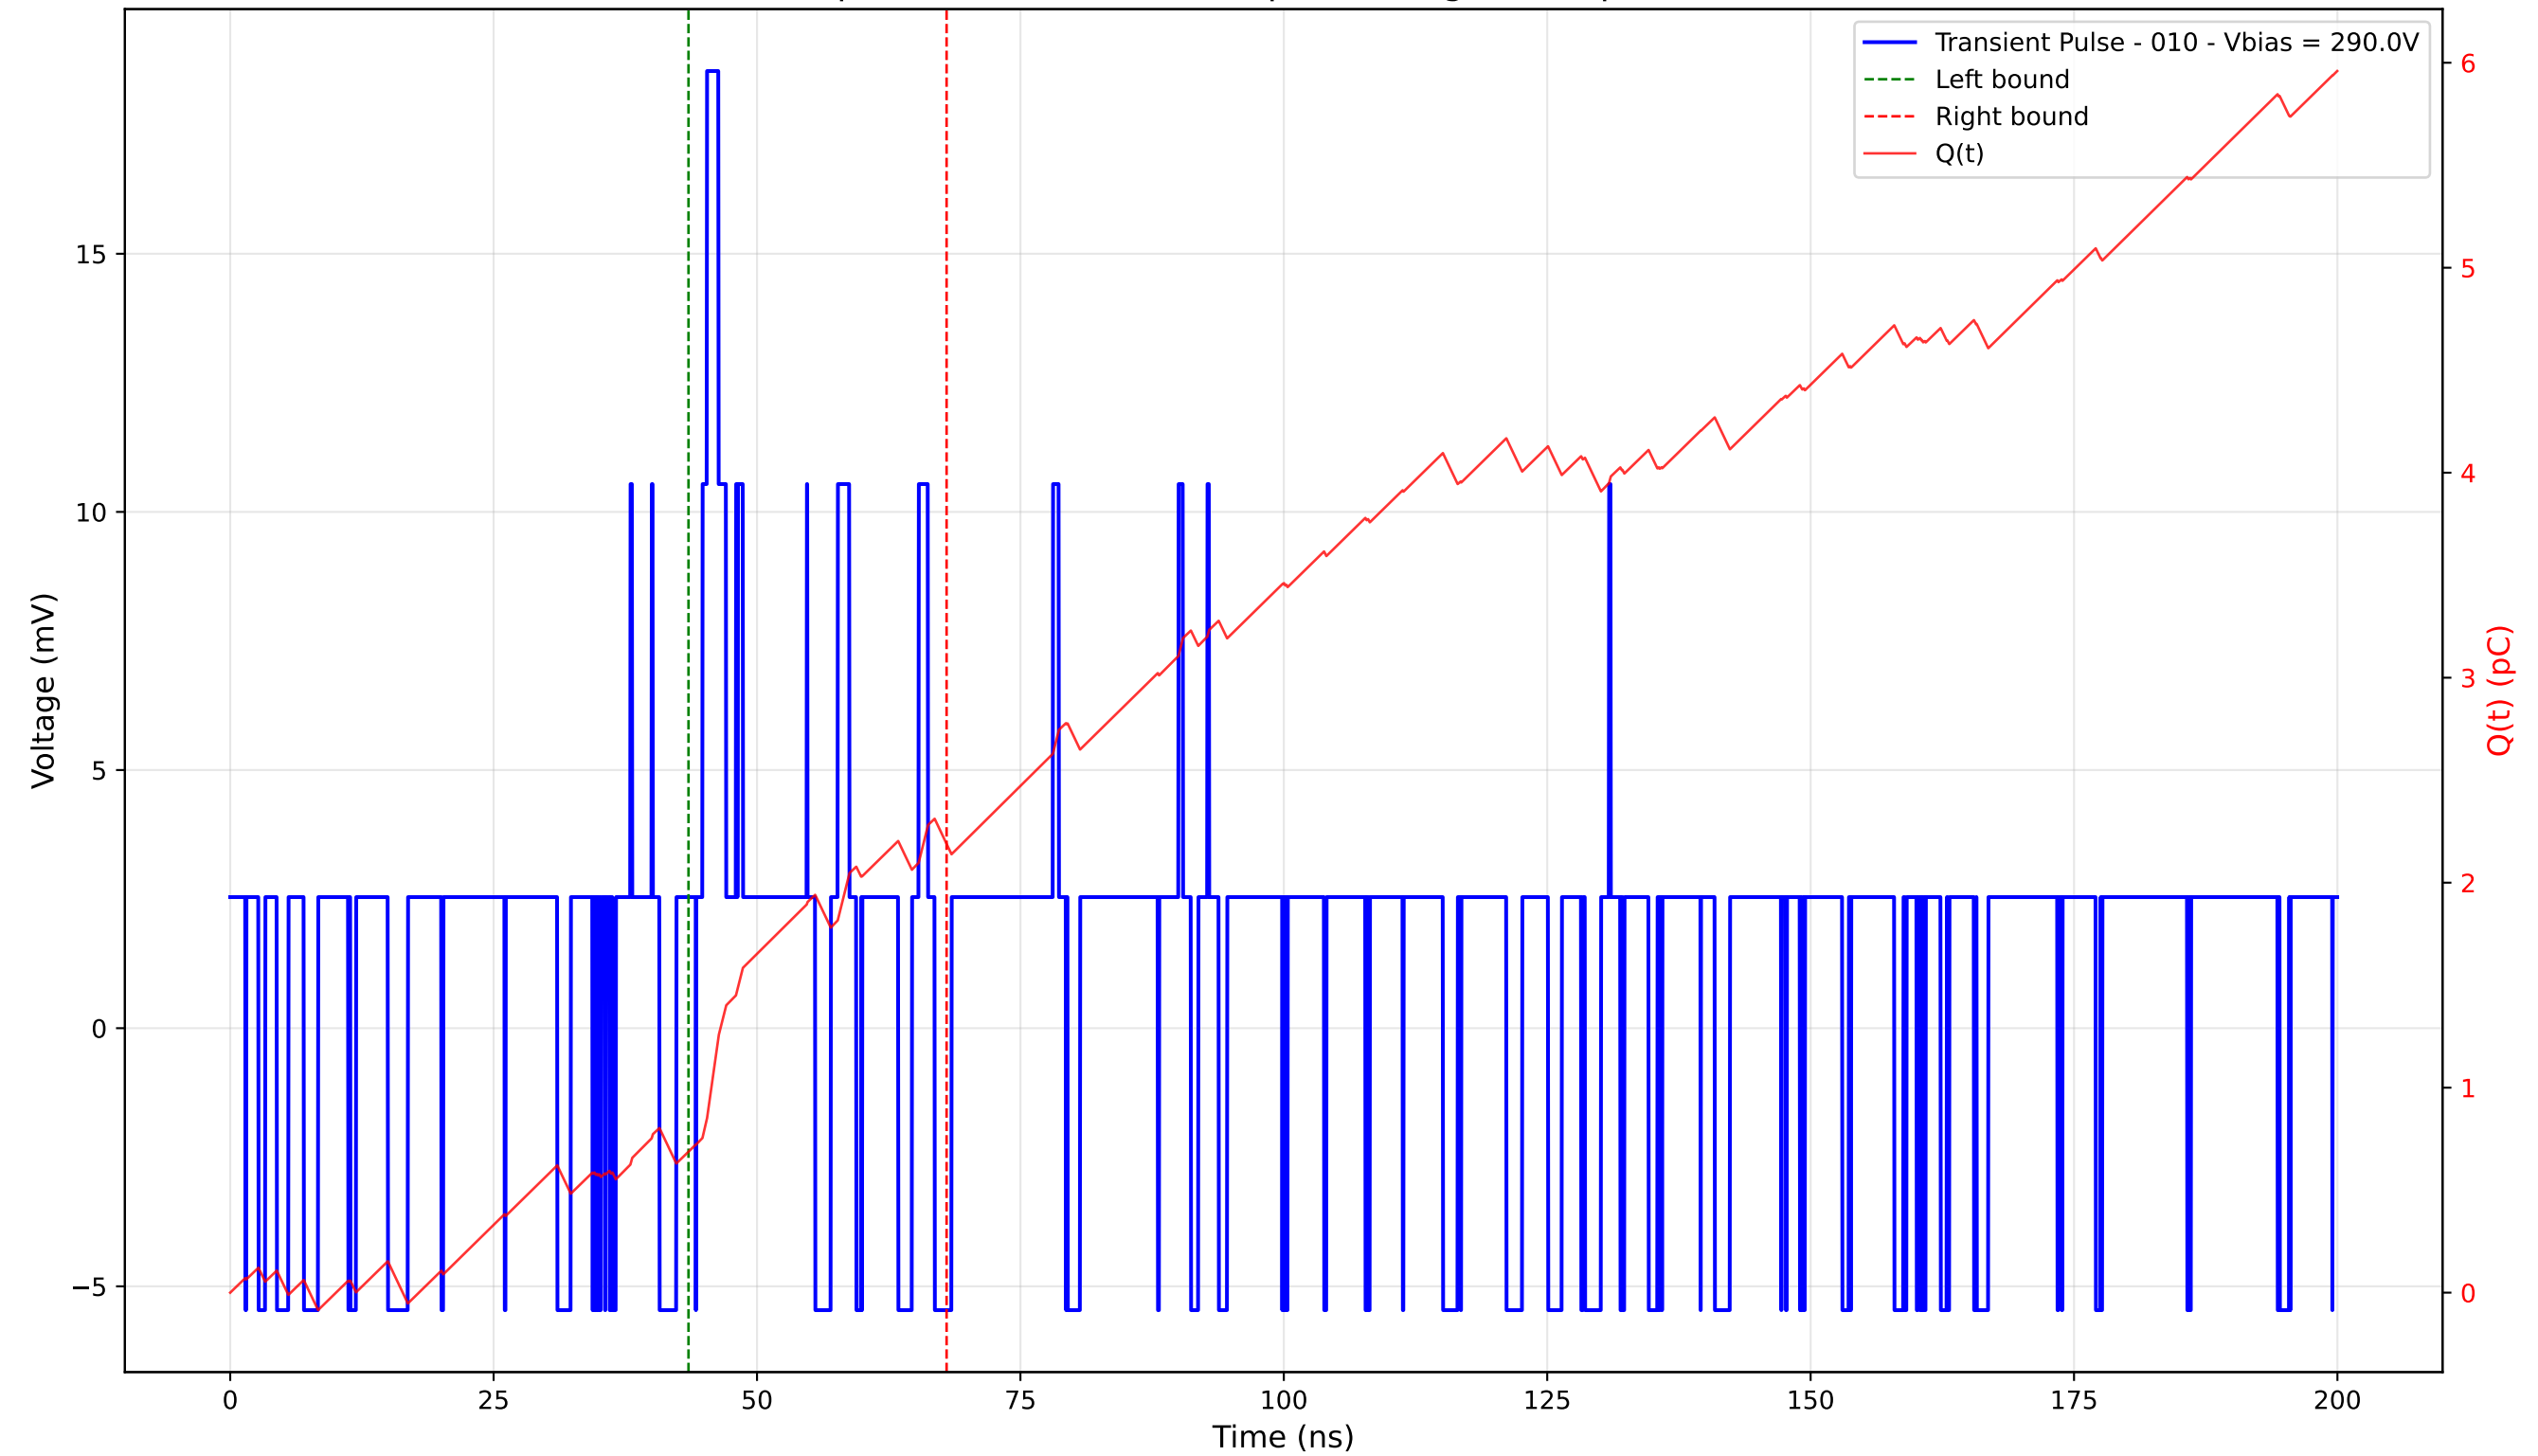


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.87 pC - Rise Time: 1.00 ns

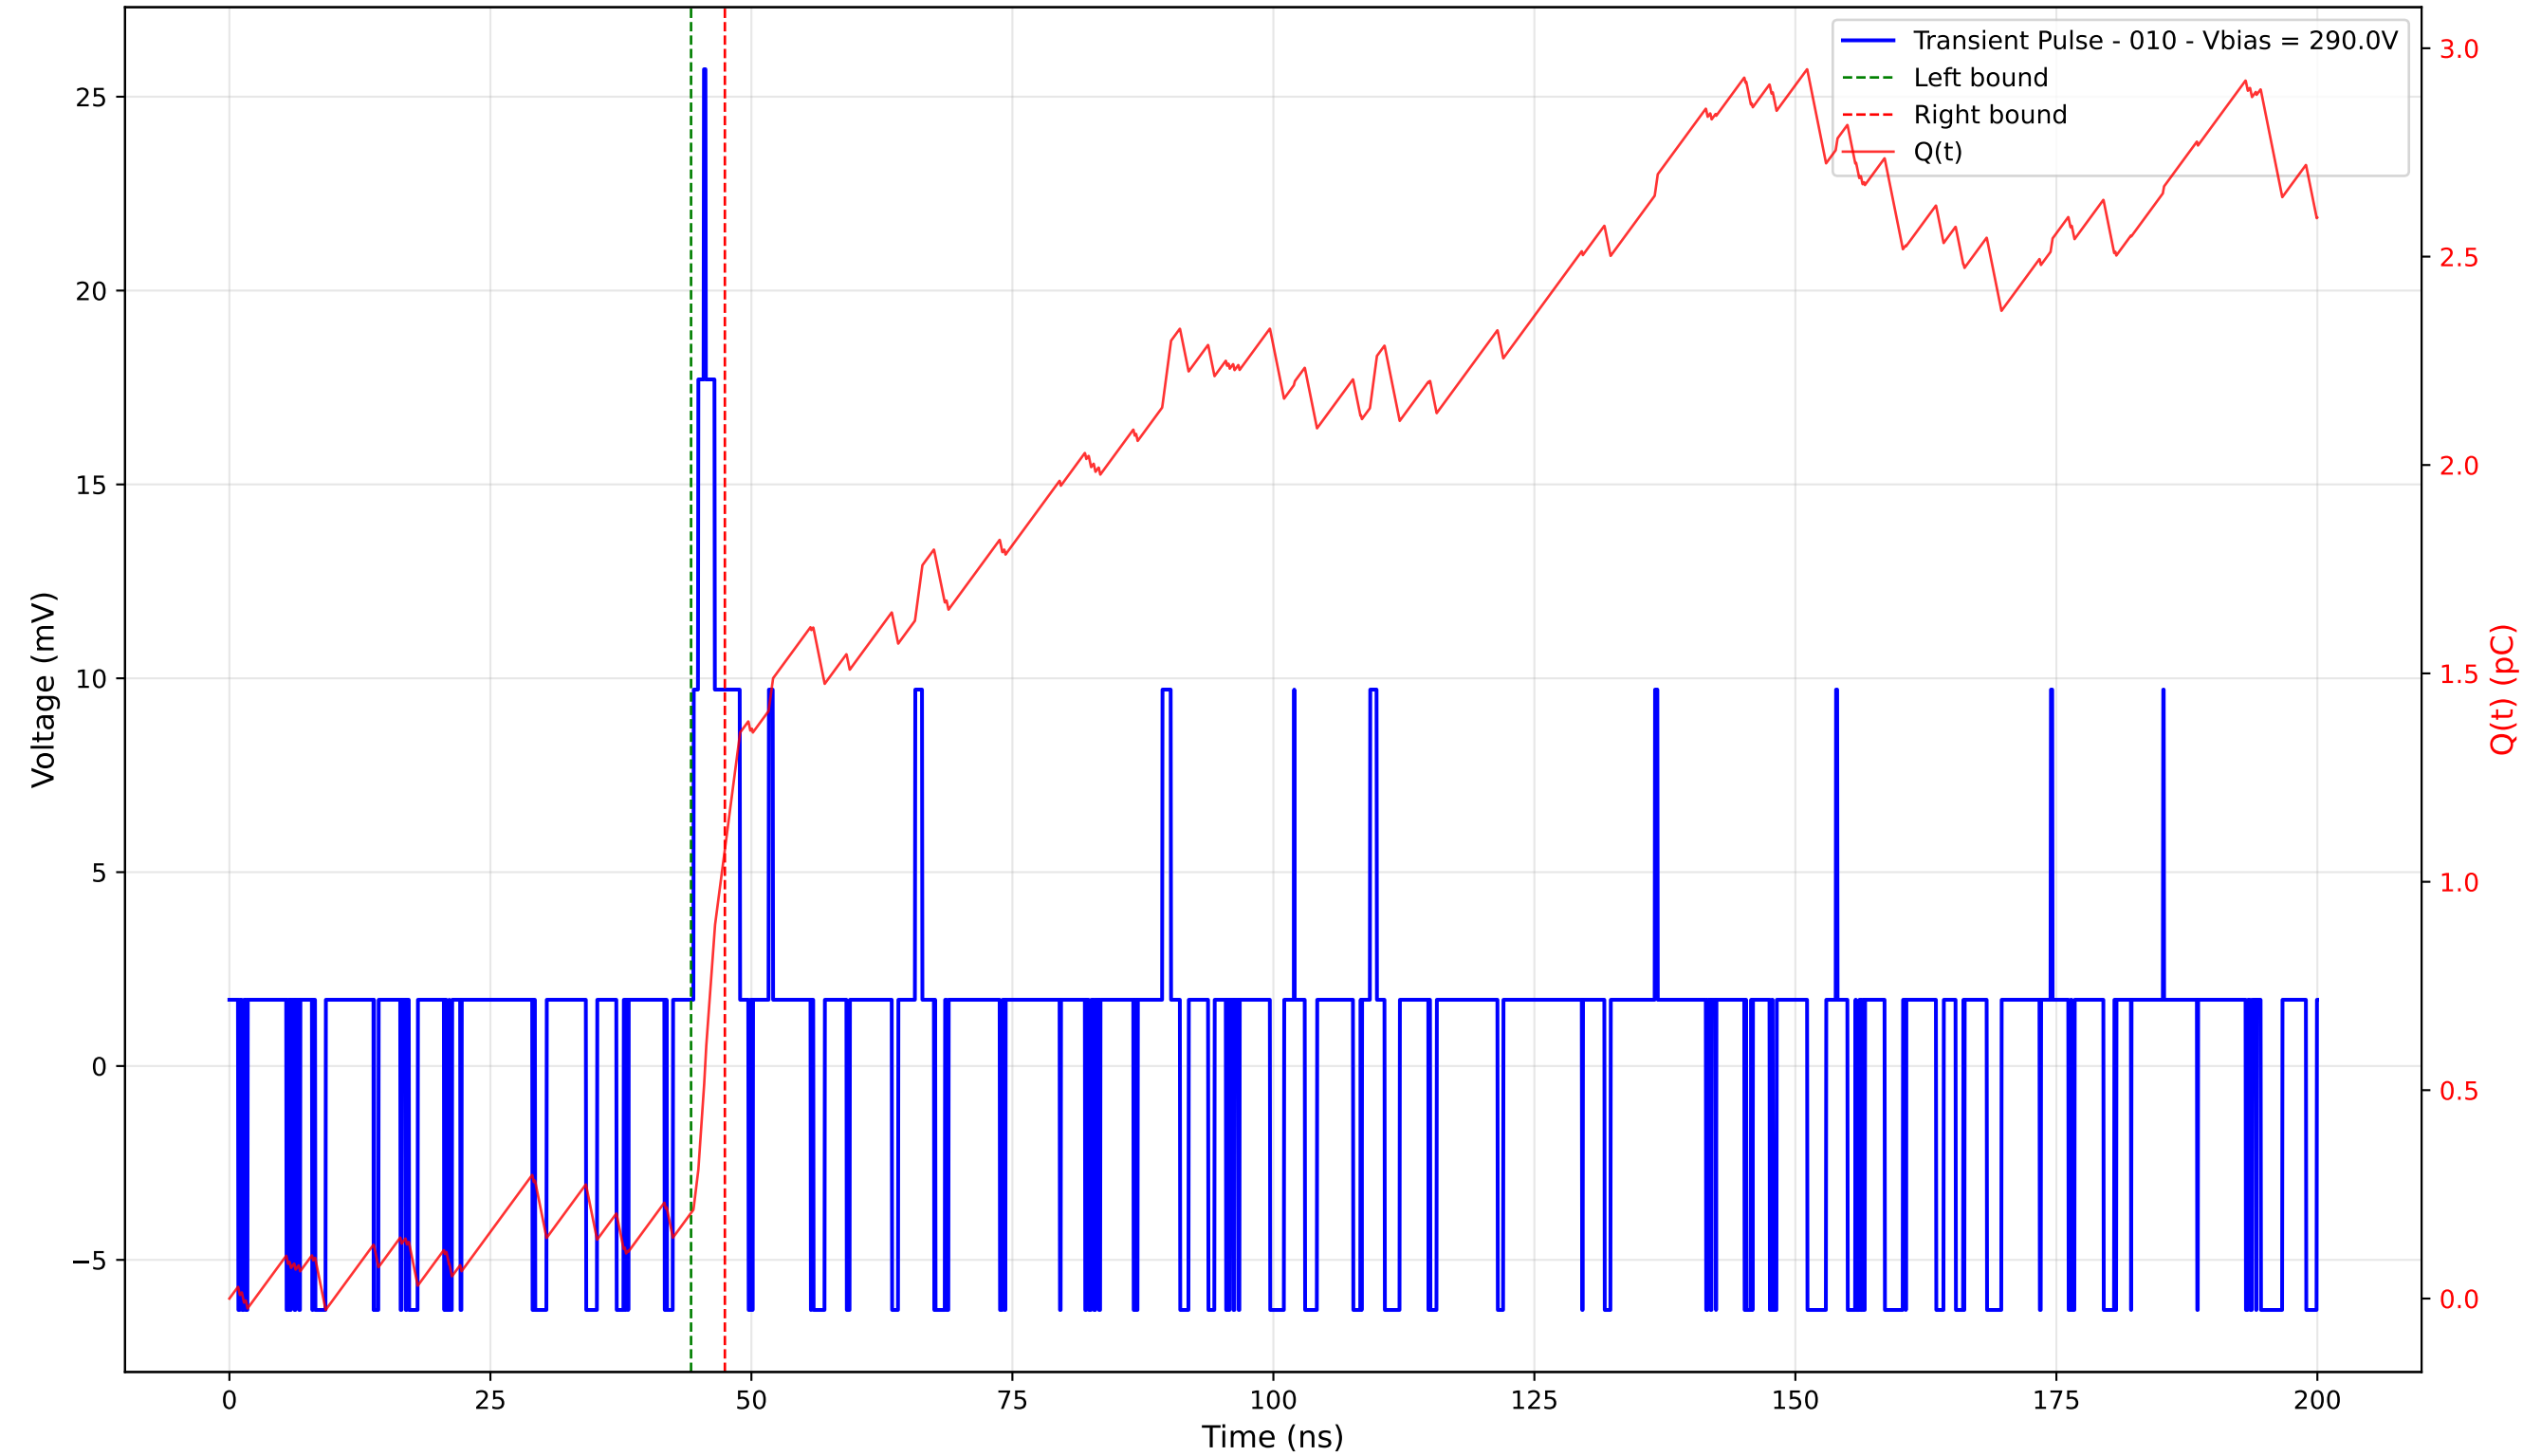


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.17 pC - Rise Time: 0.62 ns

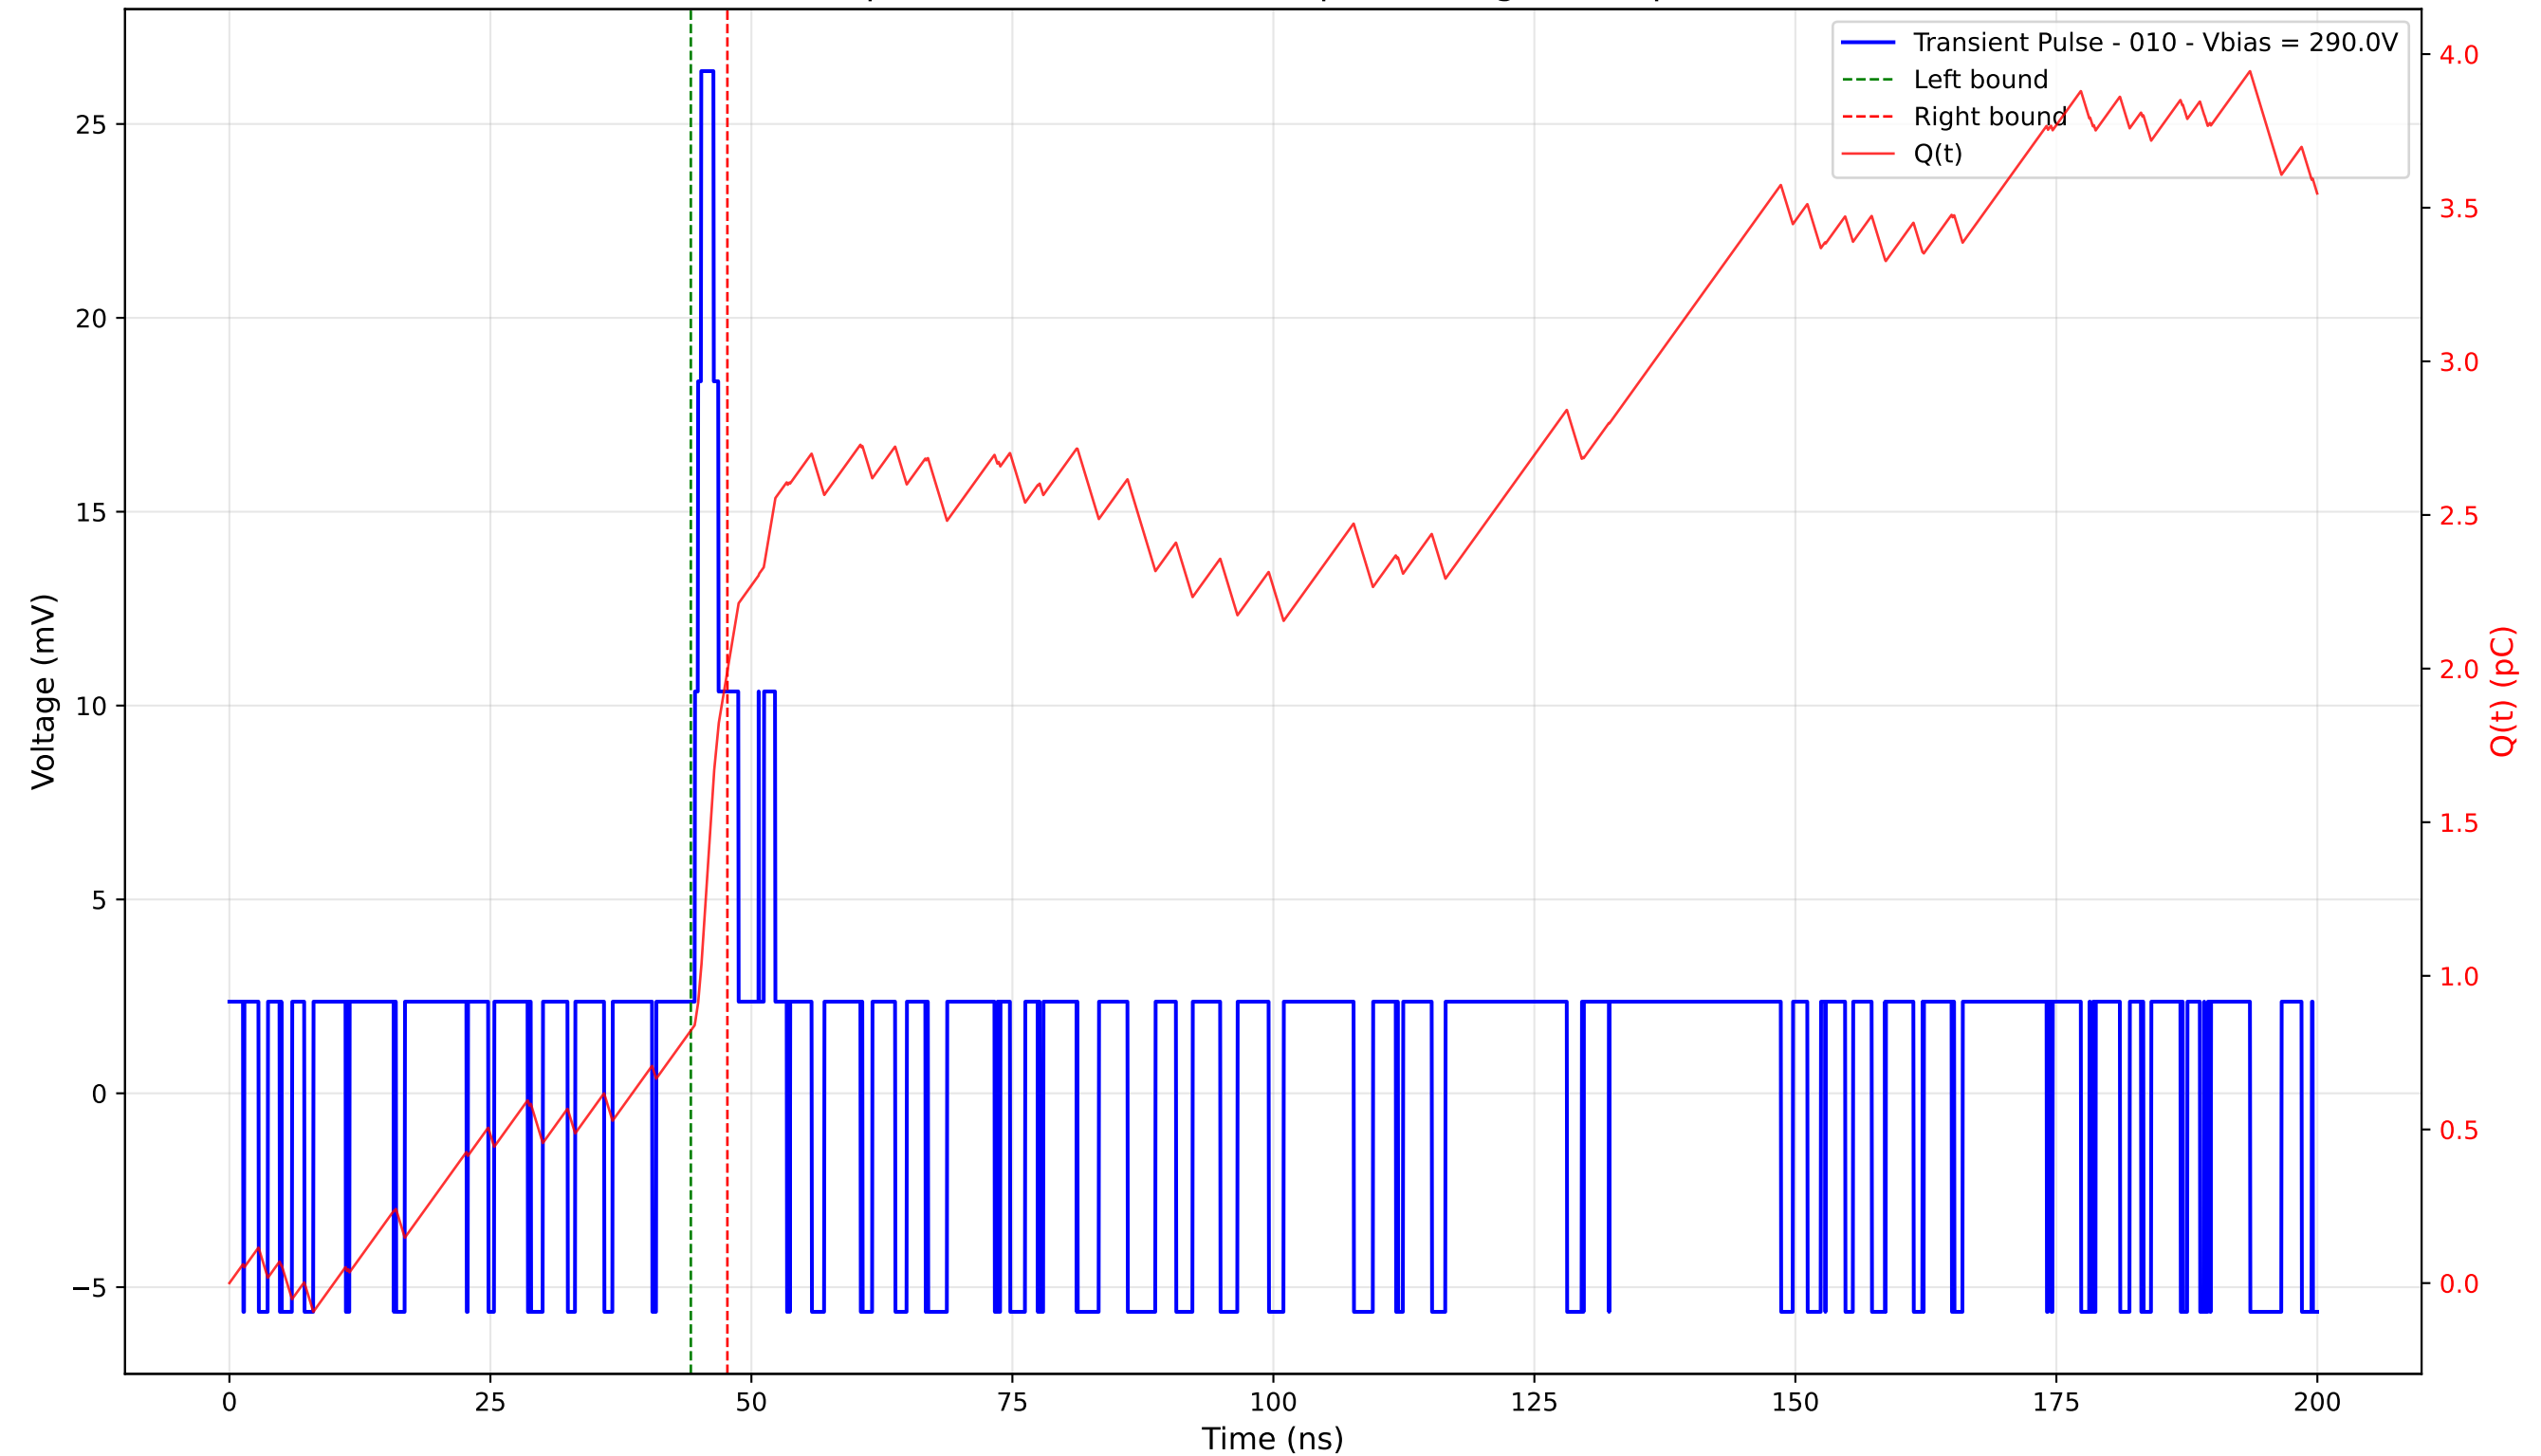


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.57 pC - Rise Time: 0.76 ns

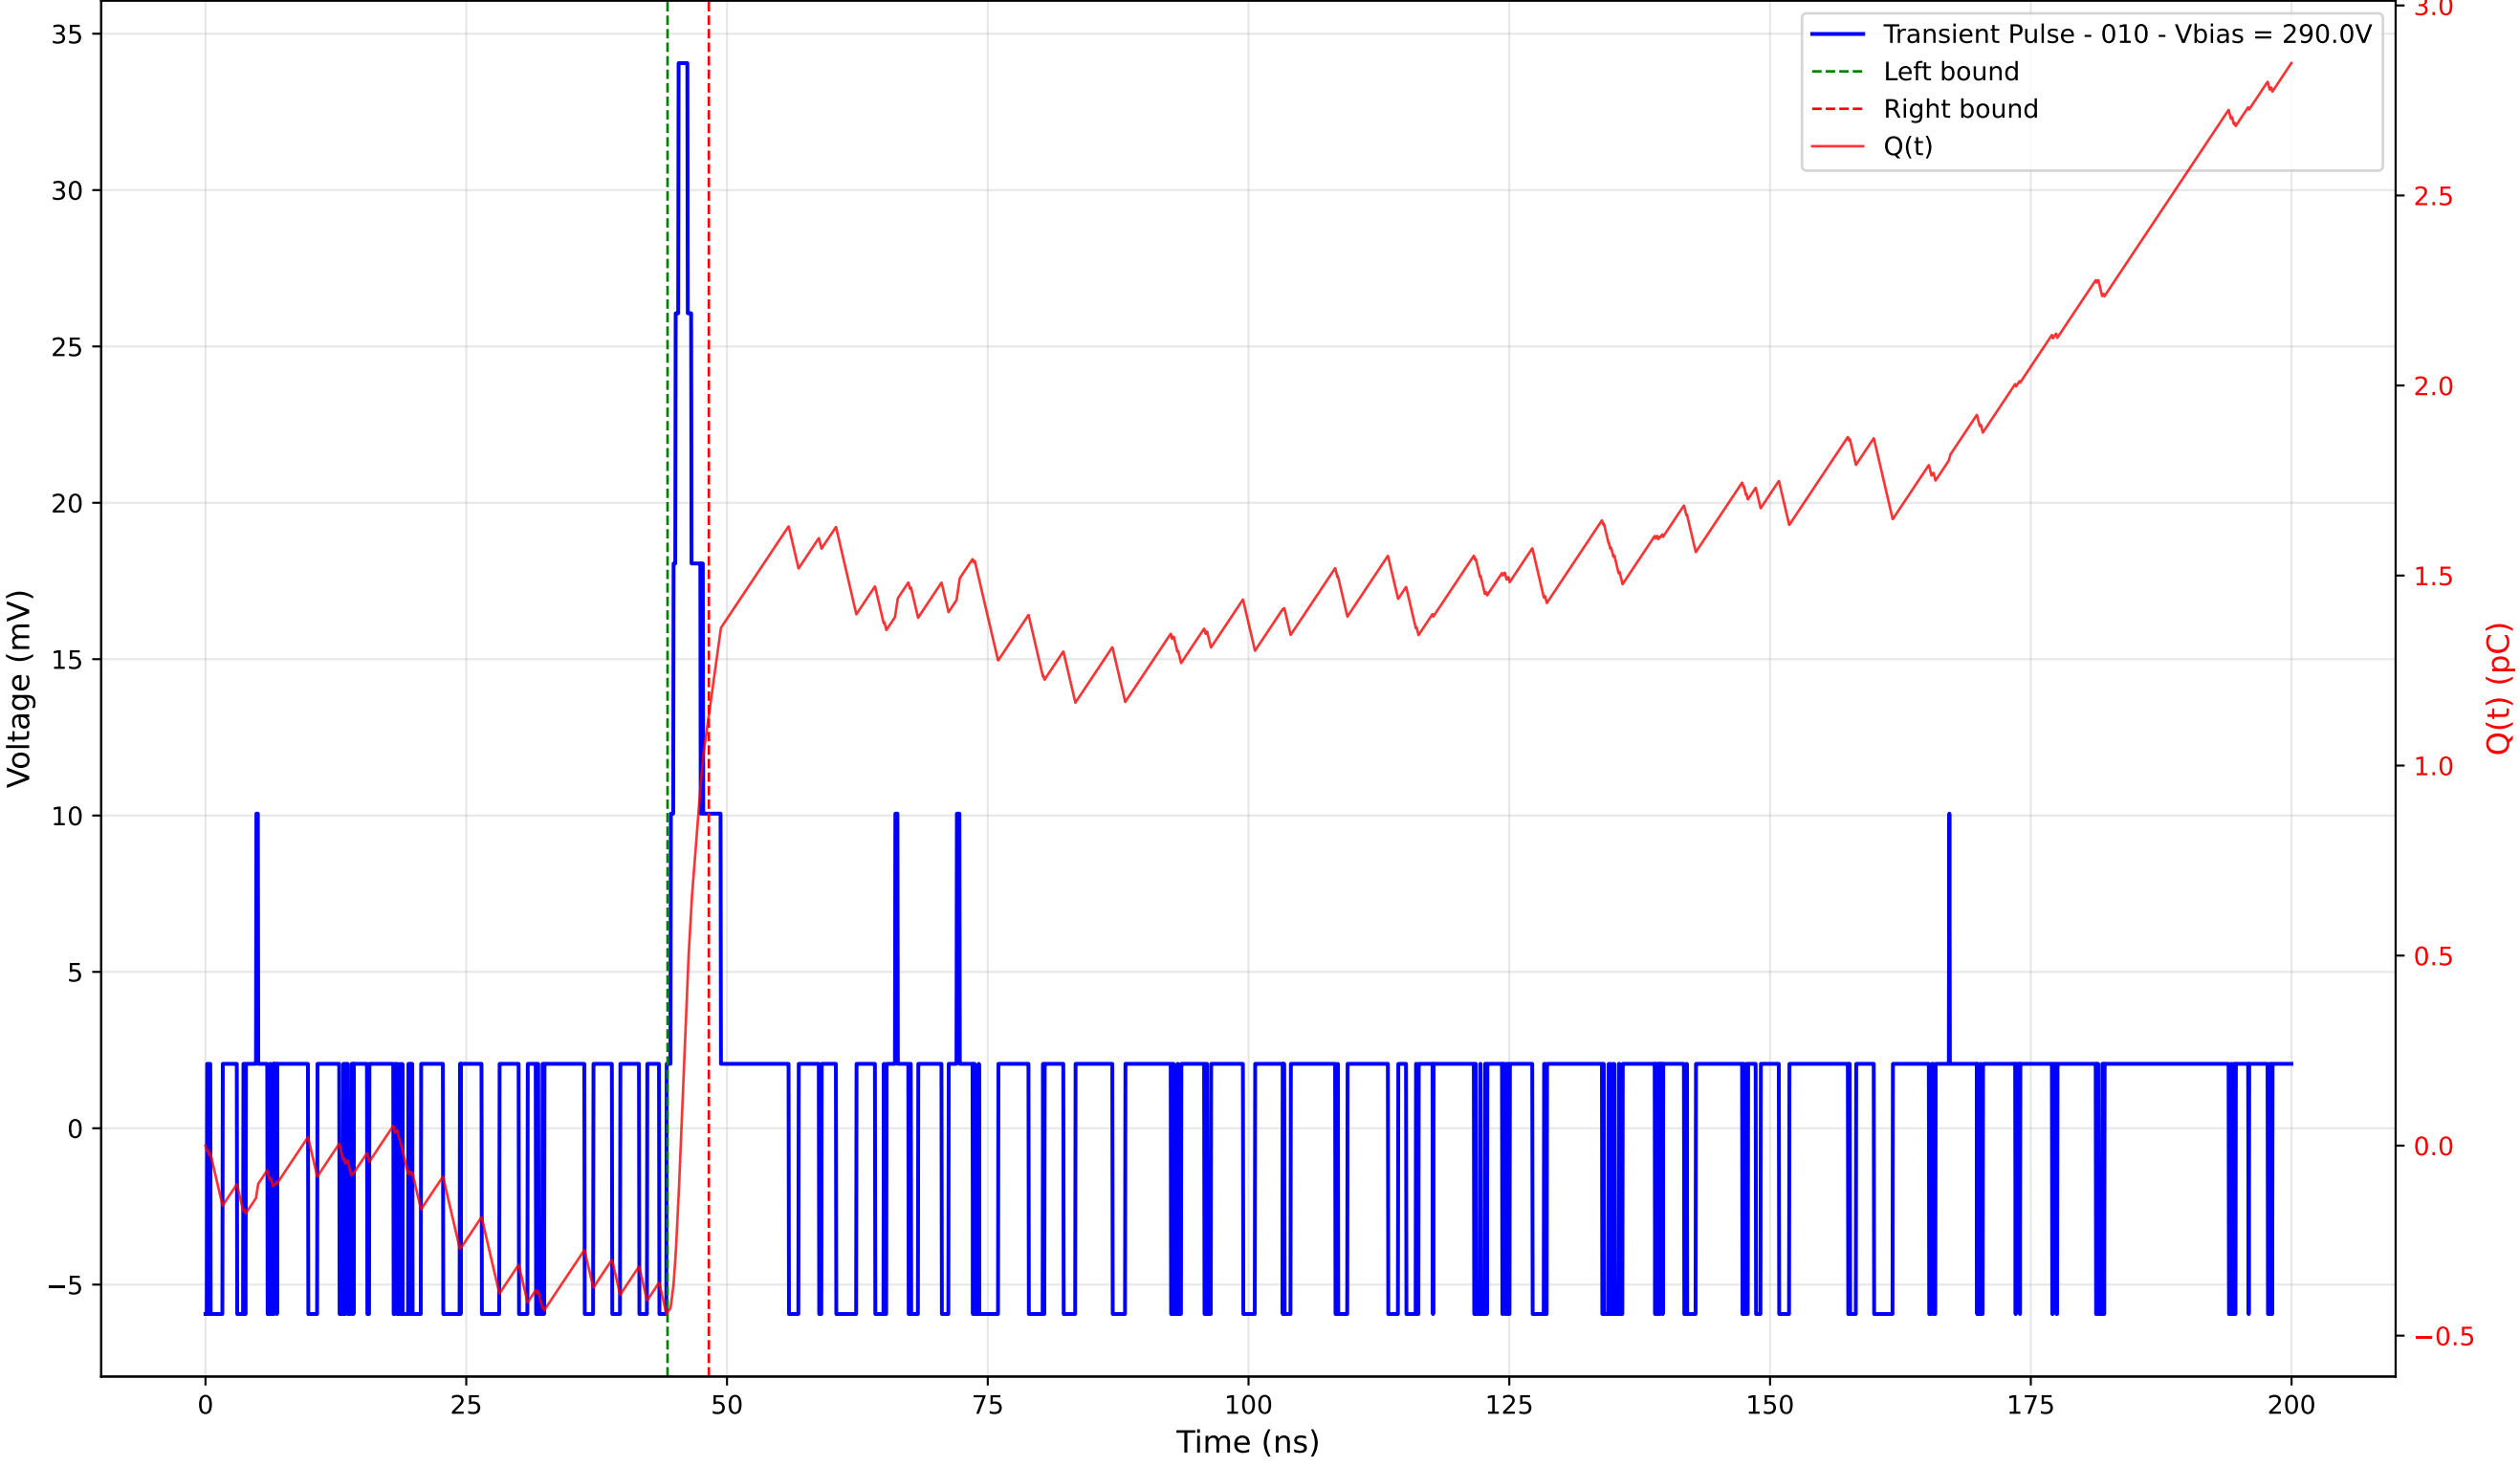


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.62 pC - Rise Time: 0.70 ns

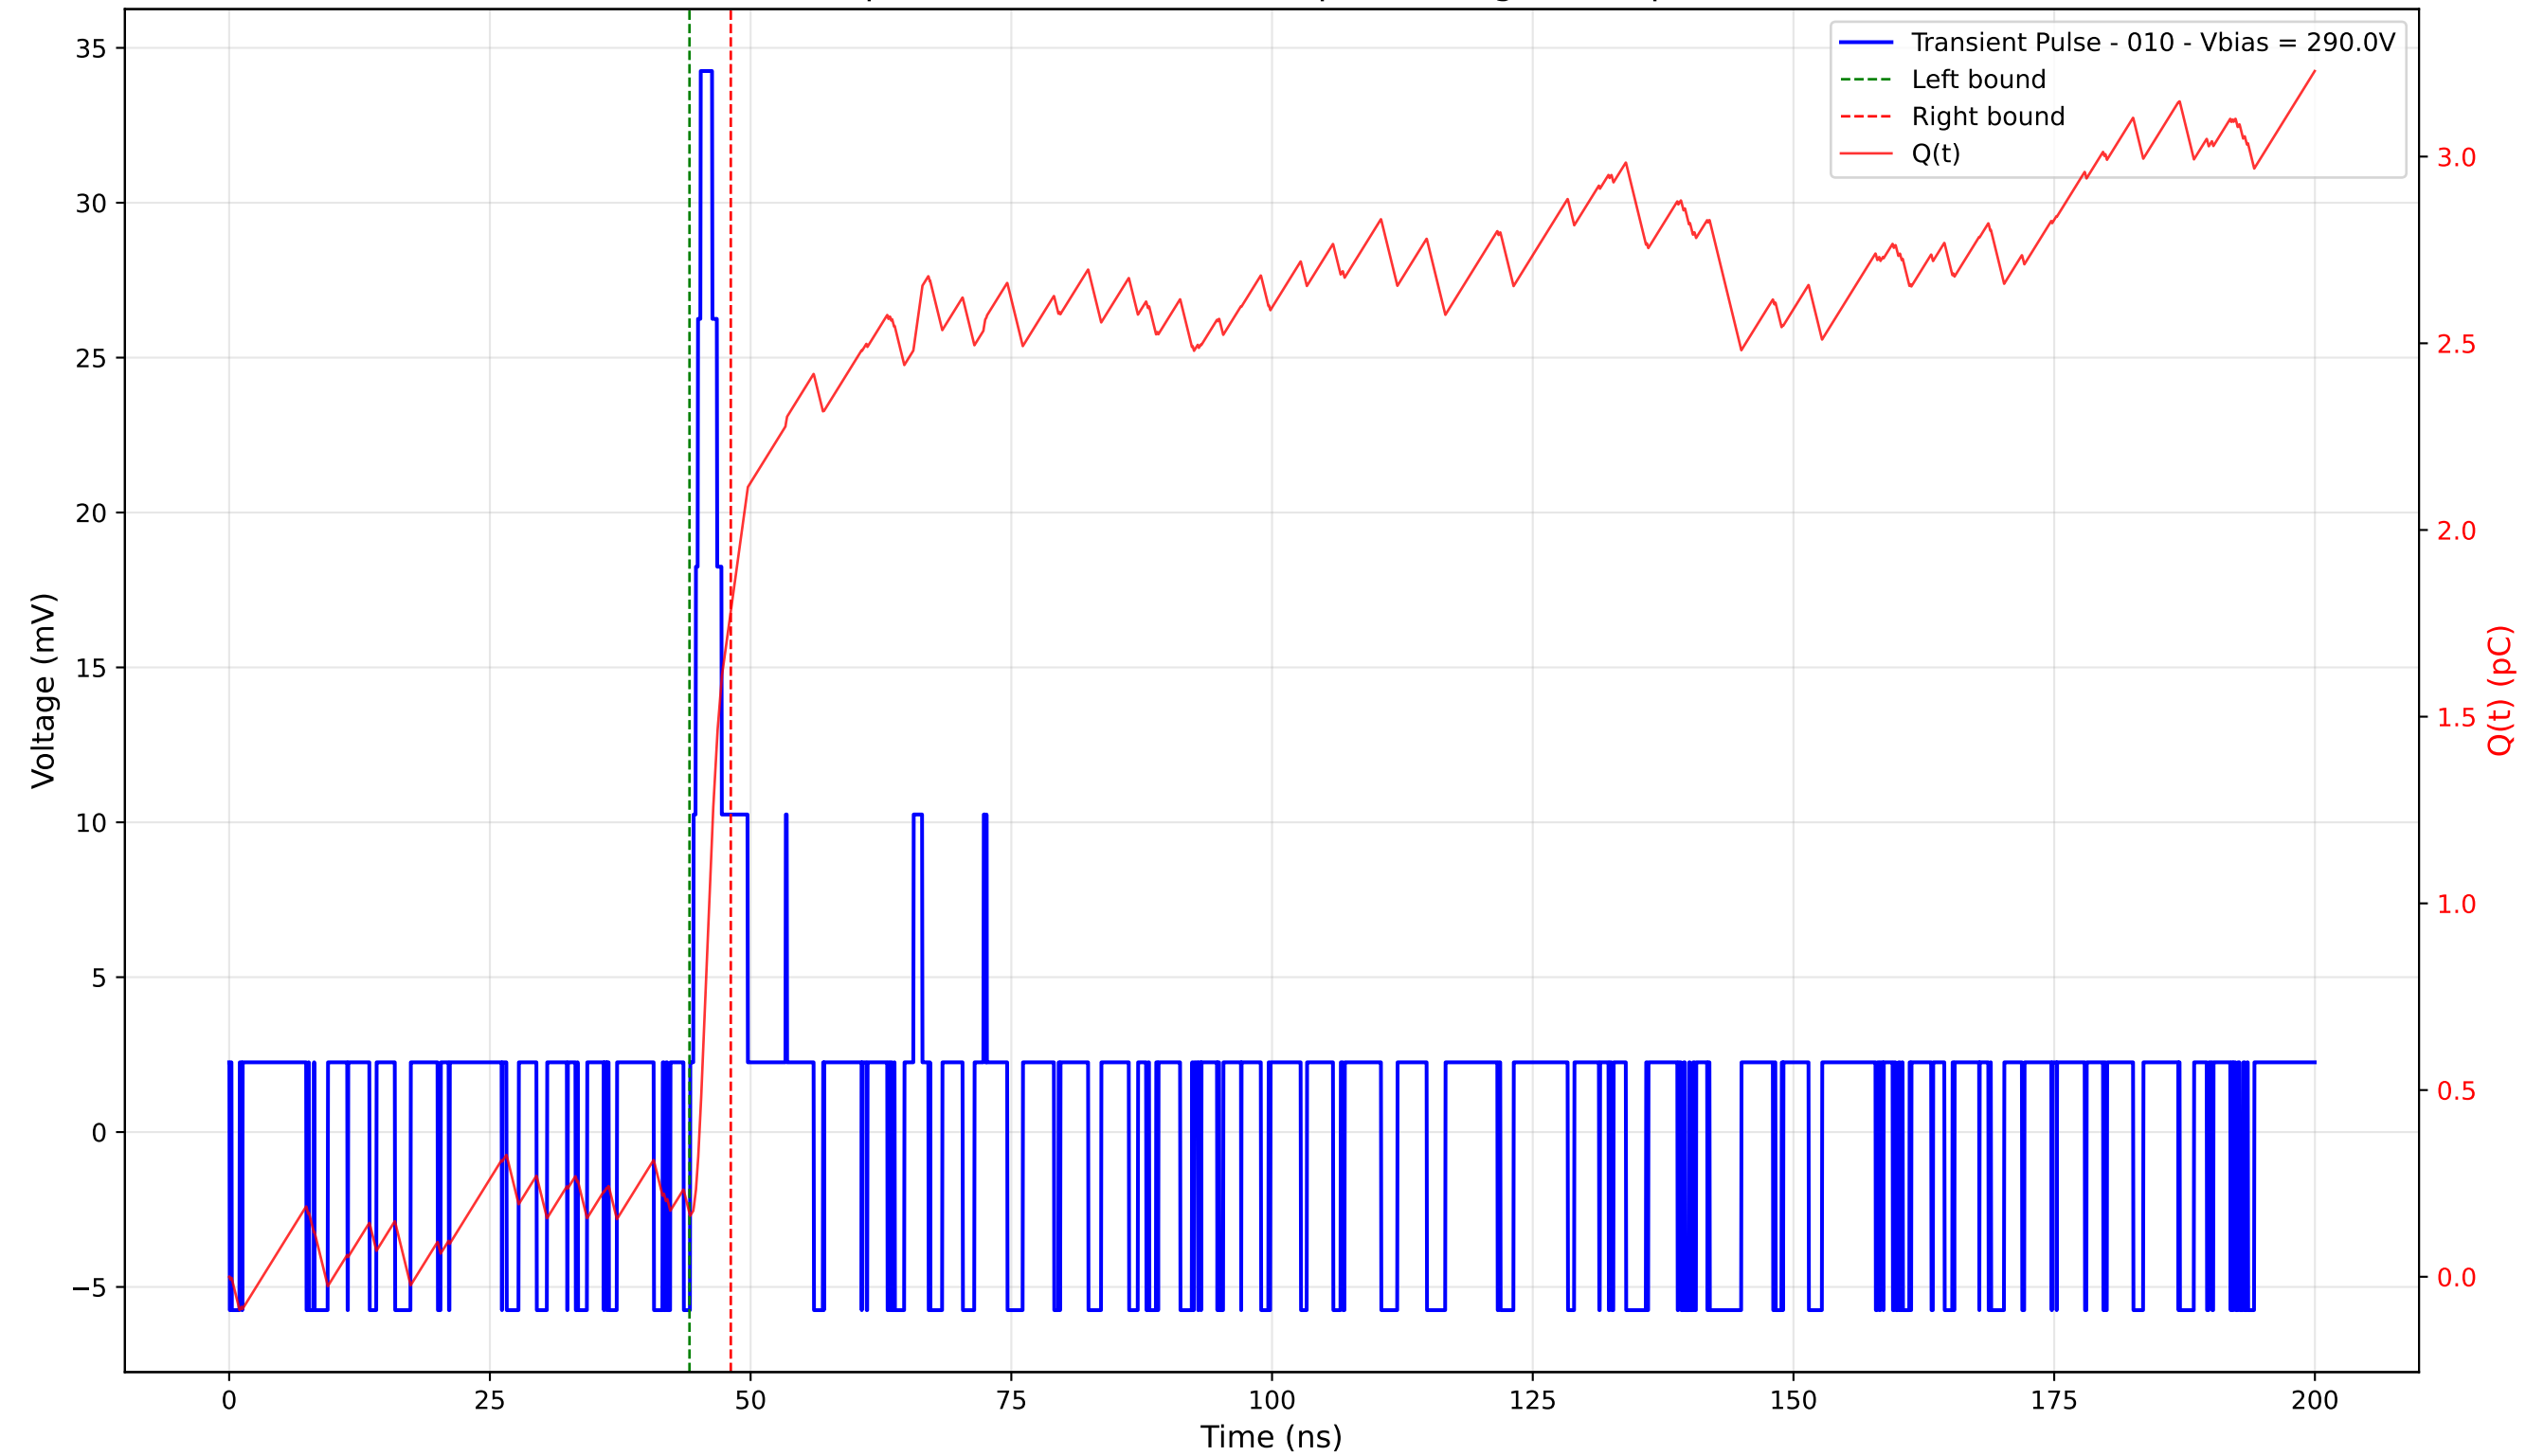


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.58 pC - Rise Time: 0.76 ns

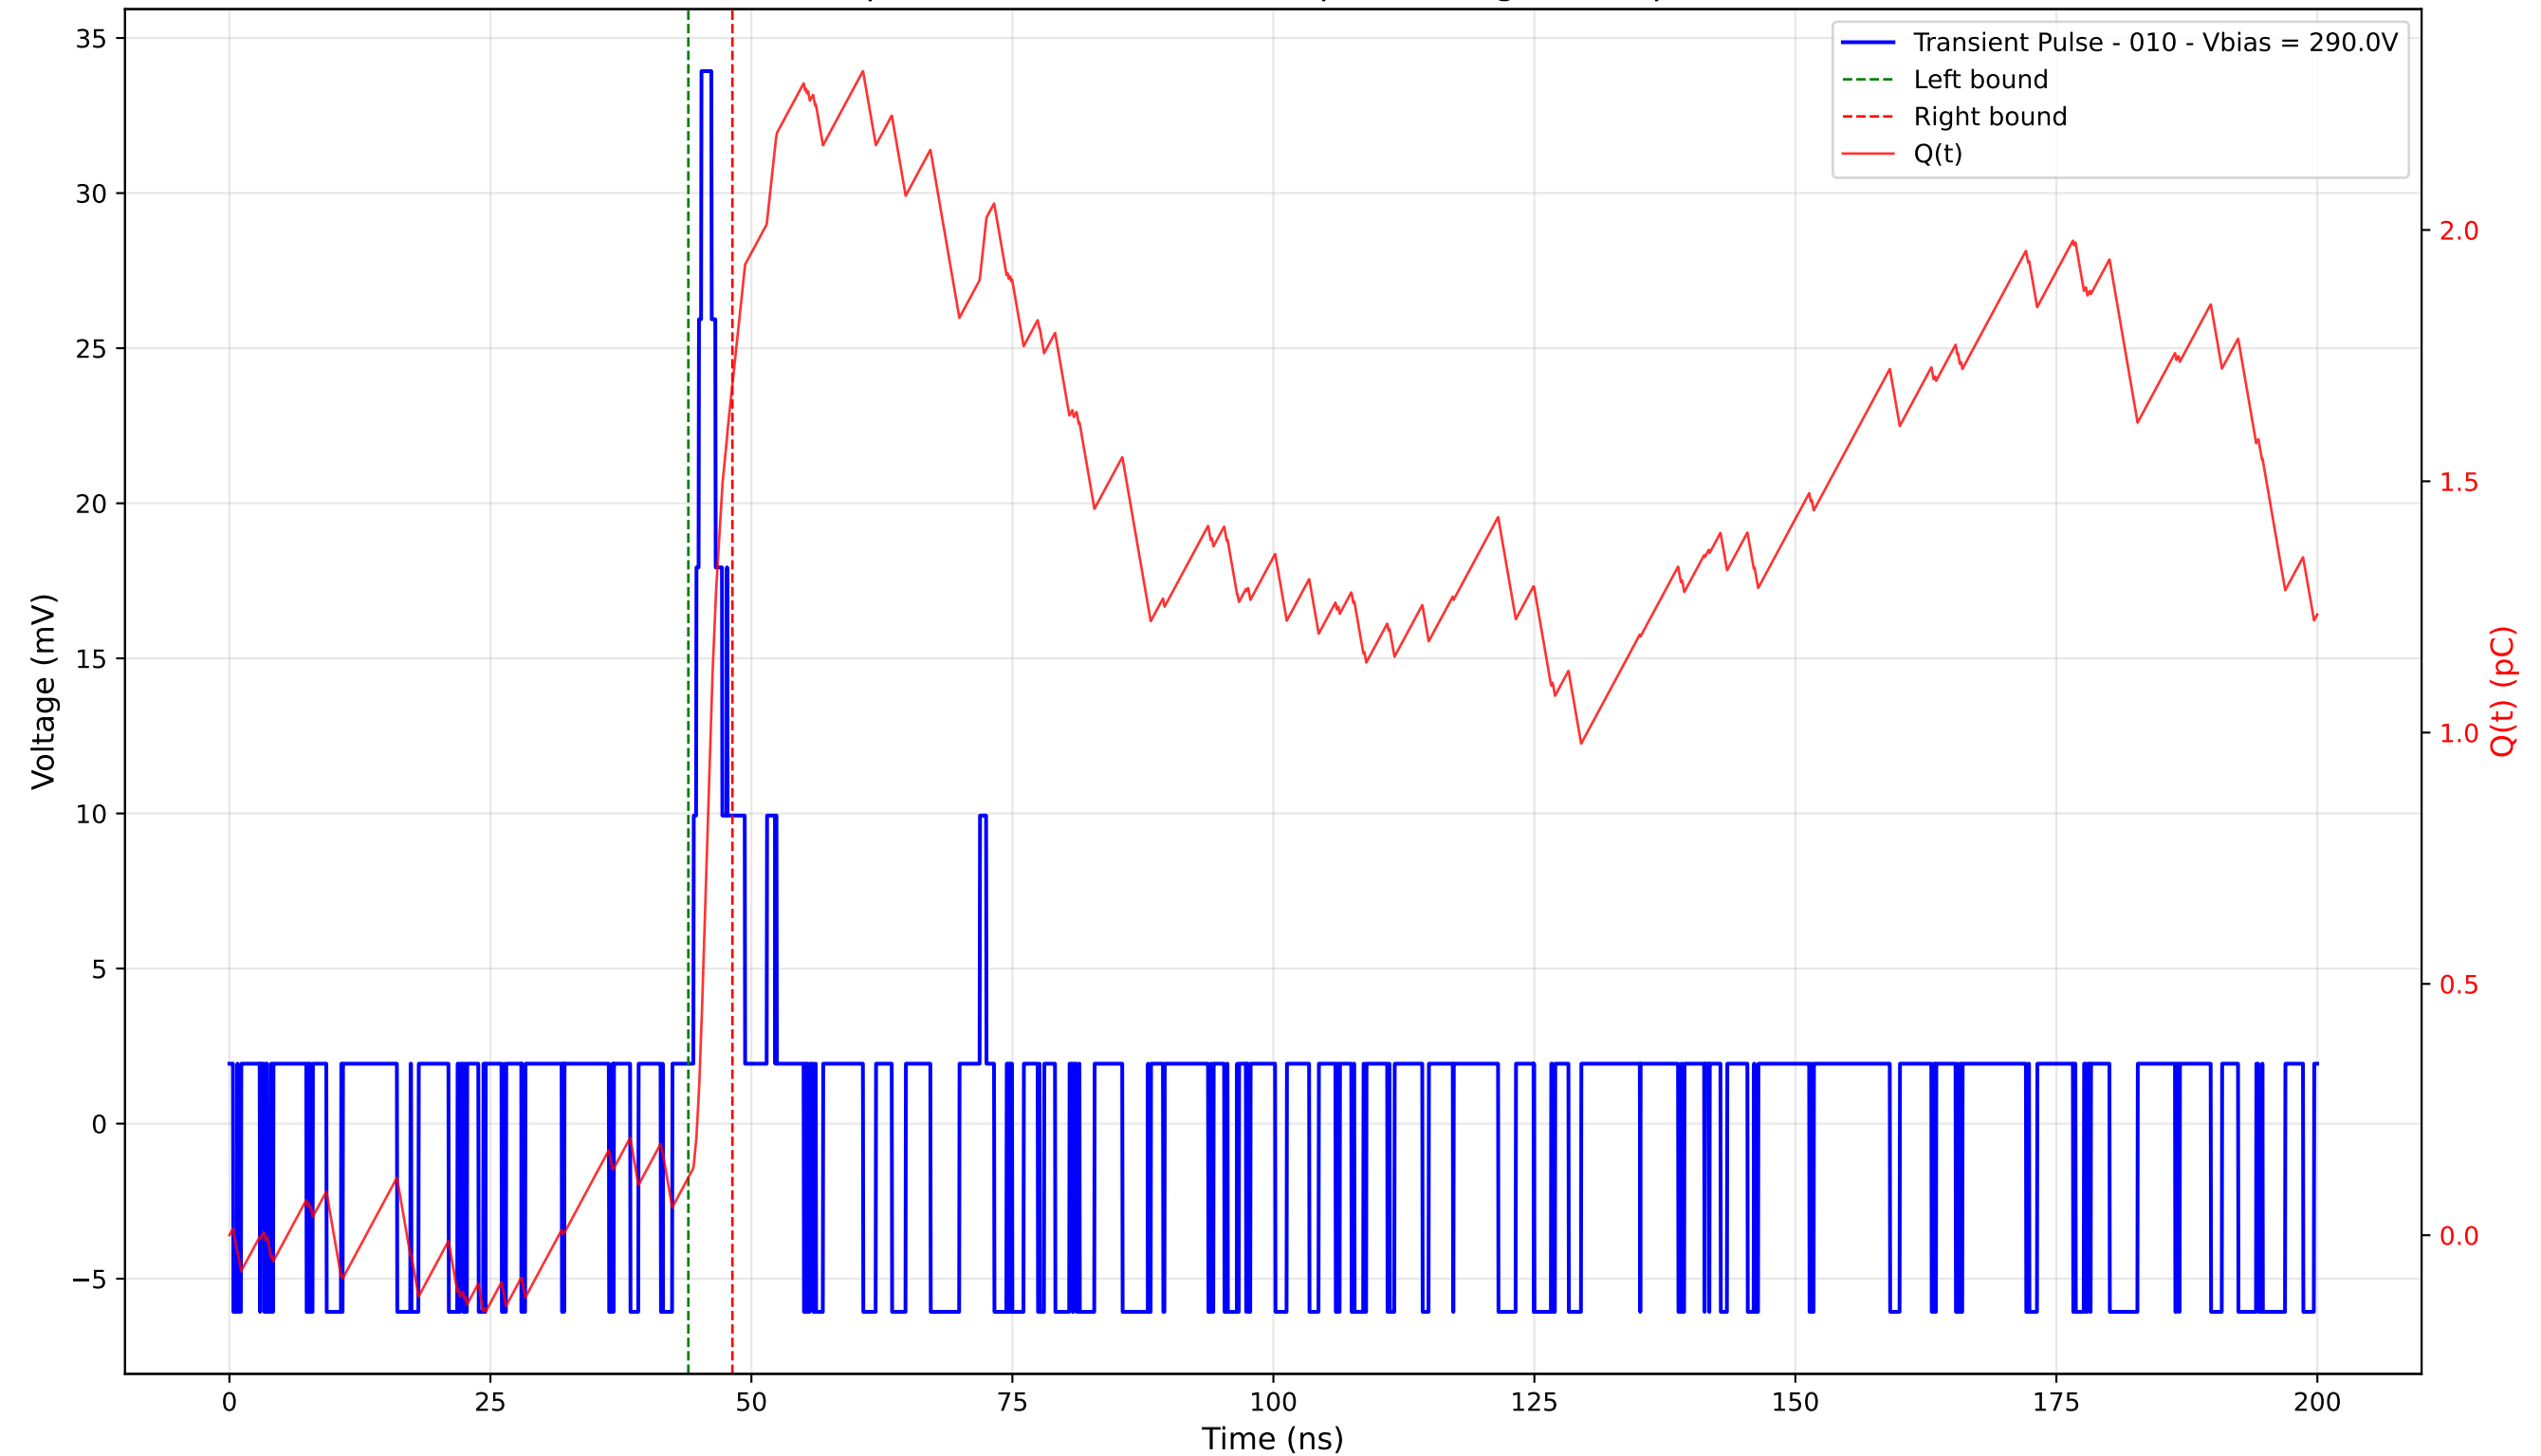


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.51 pC - Rise Time: 0.84 ns

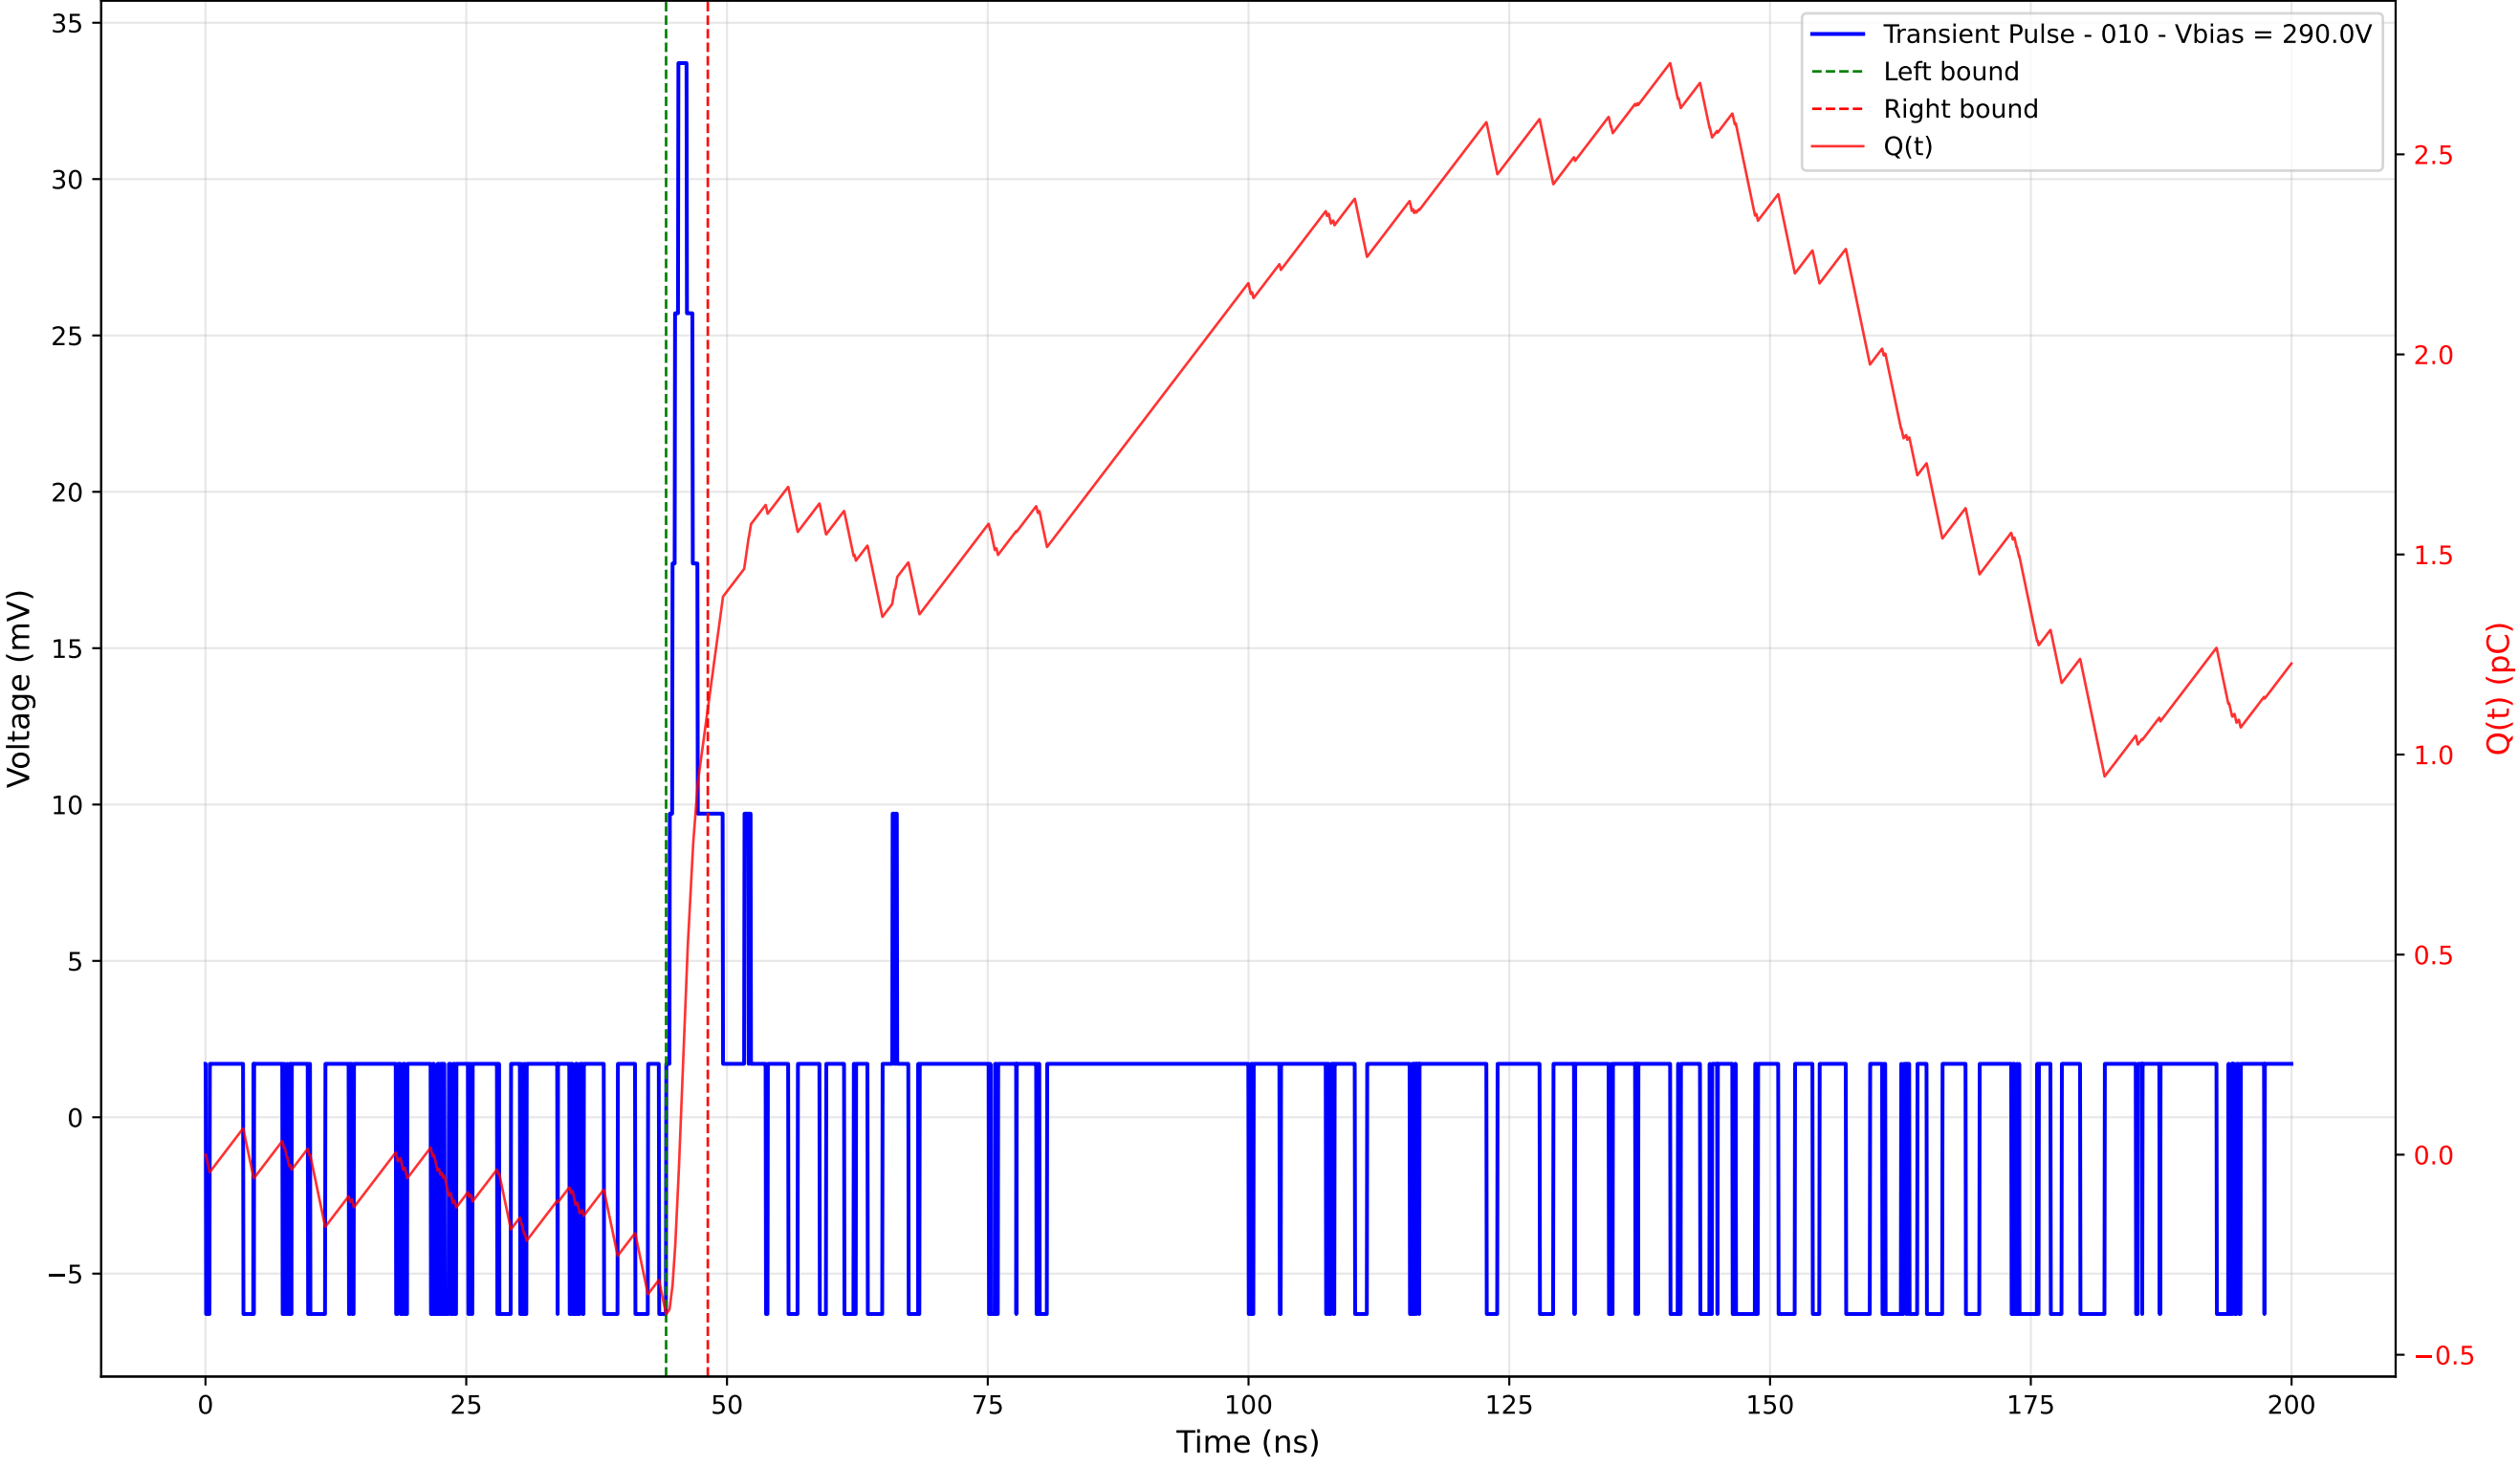


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.96 pC - Rise Time: 0.92 ns

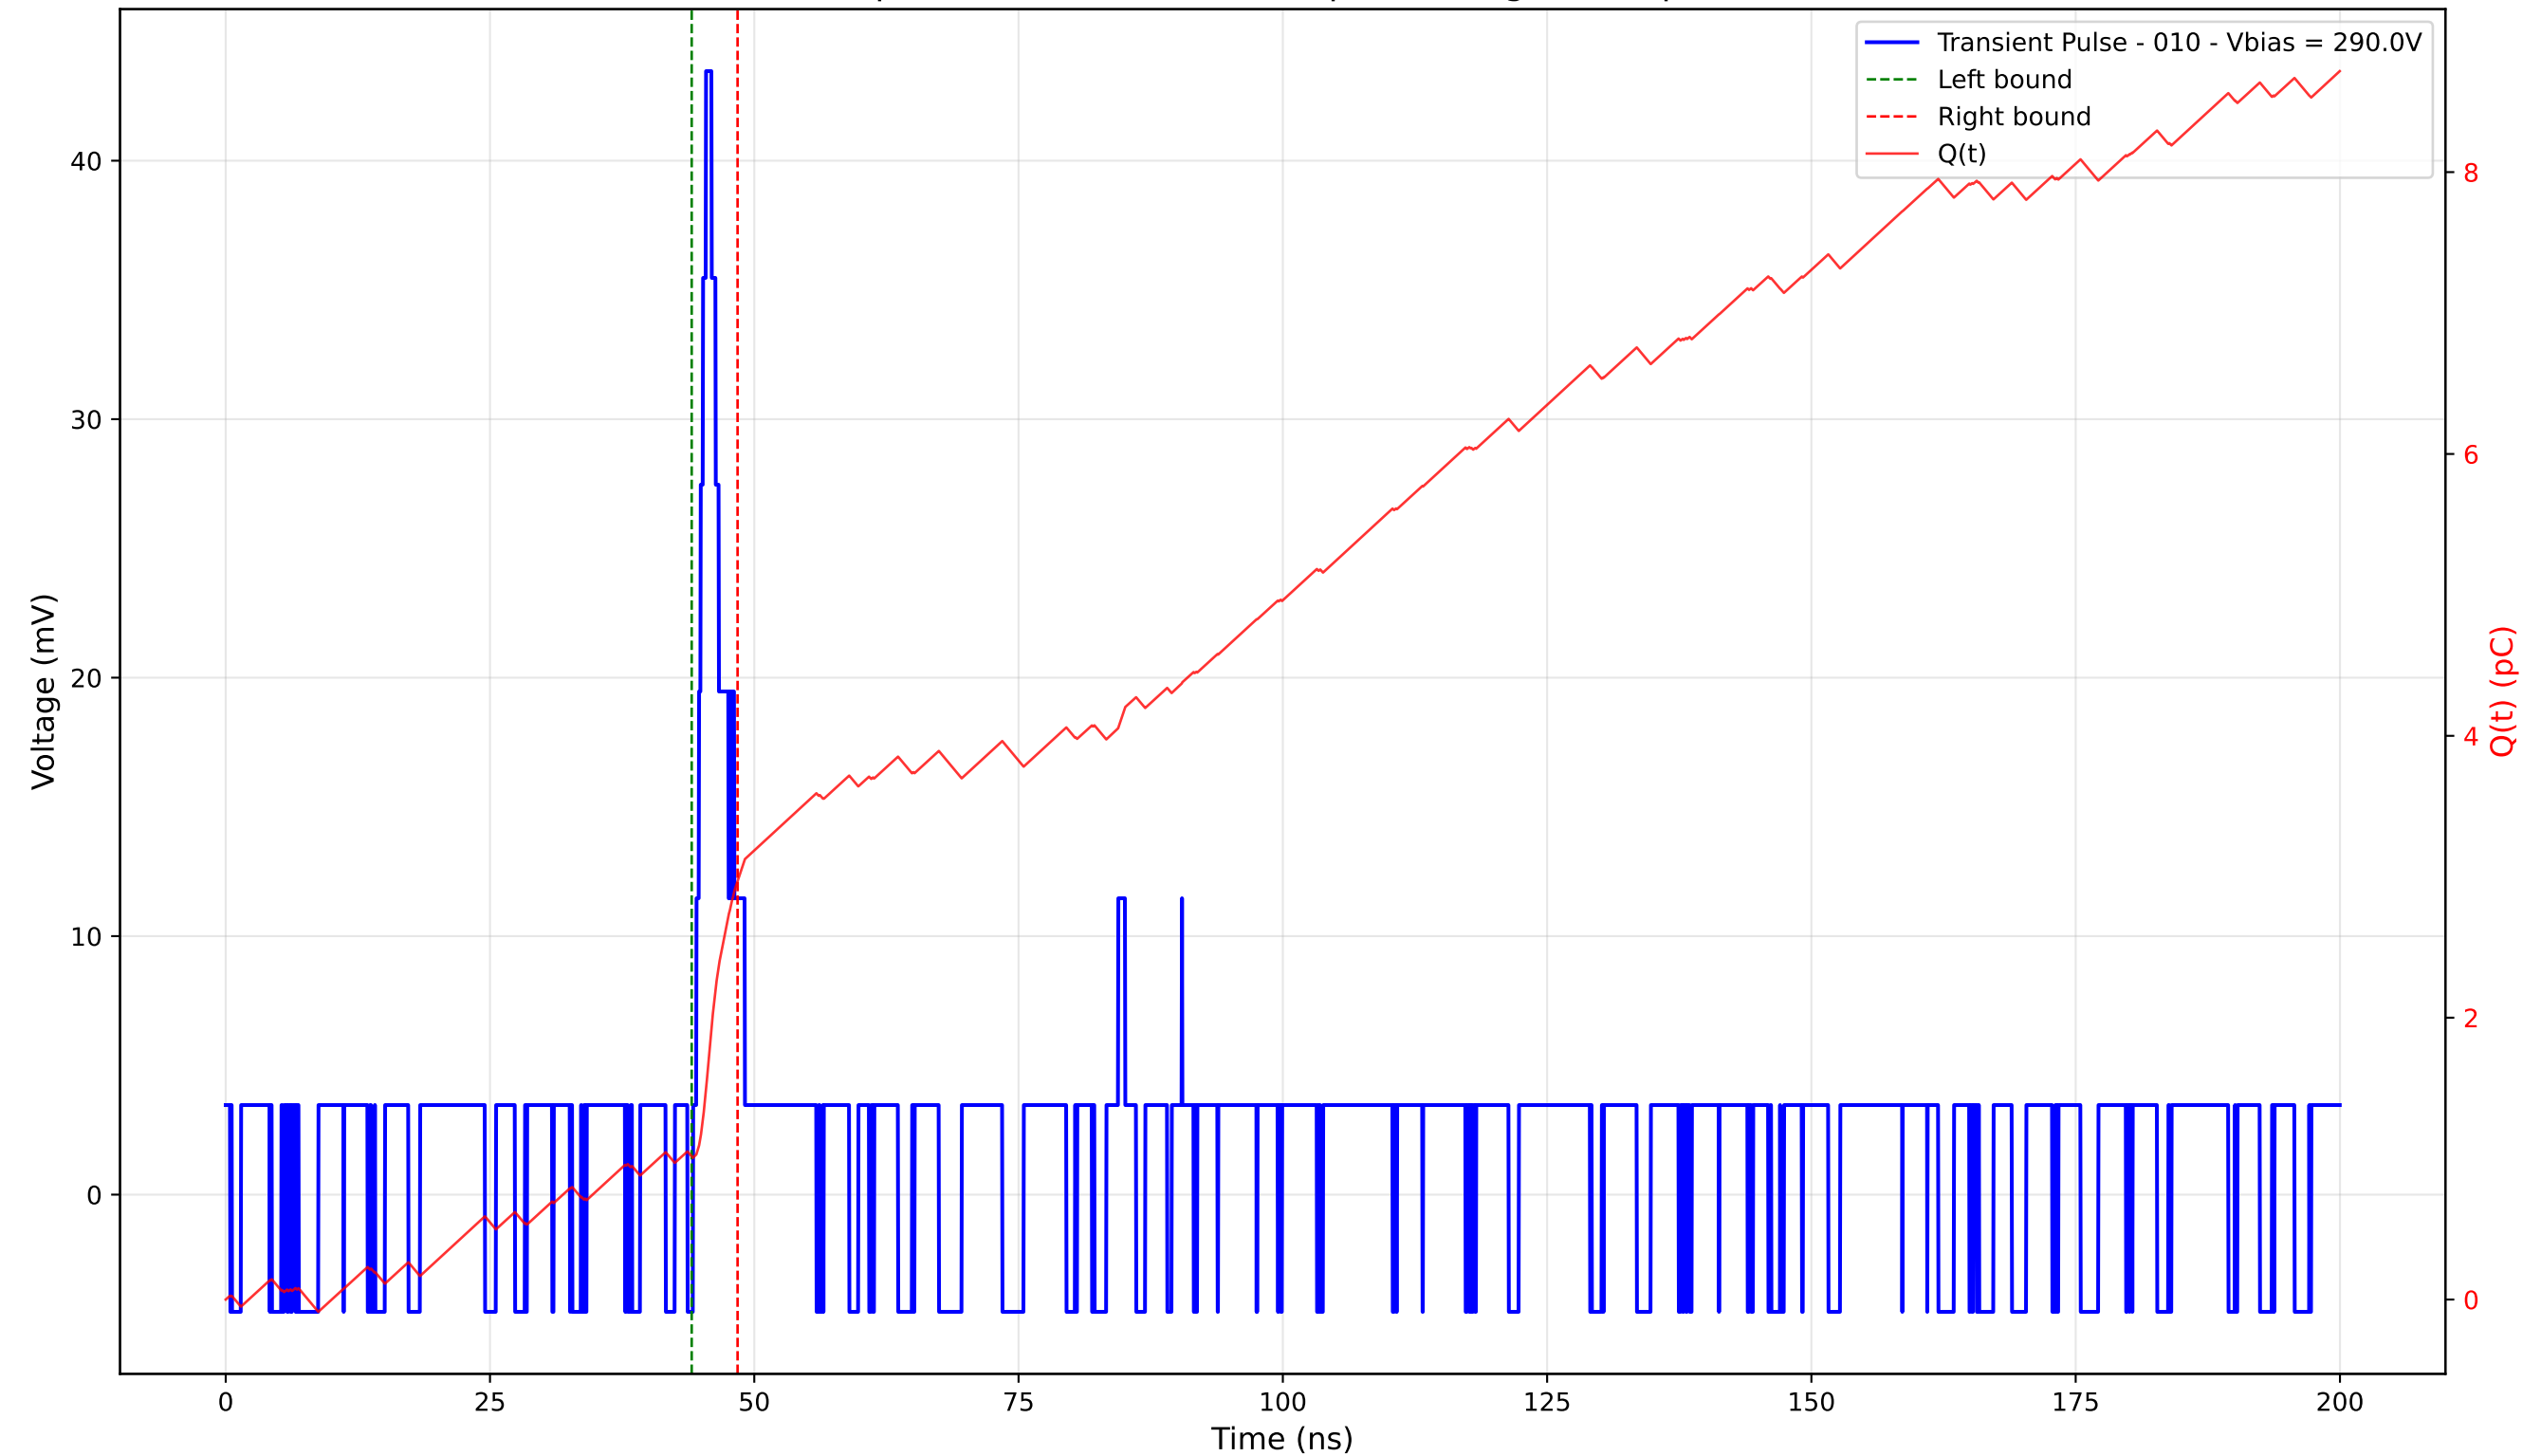


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.72 pC - Rise Time: 0.95 ns

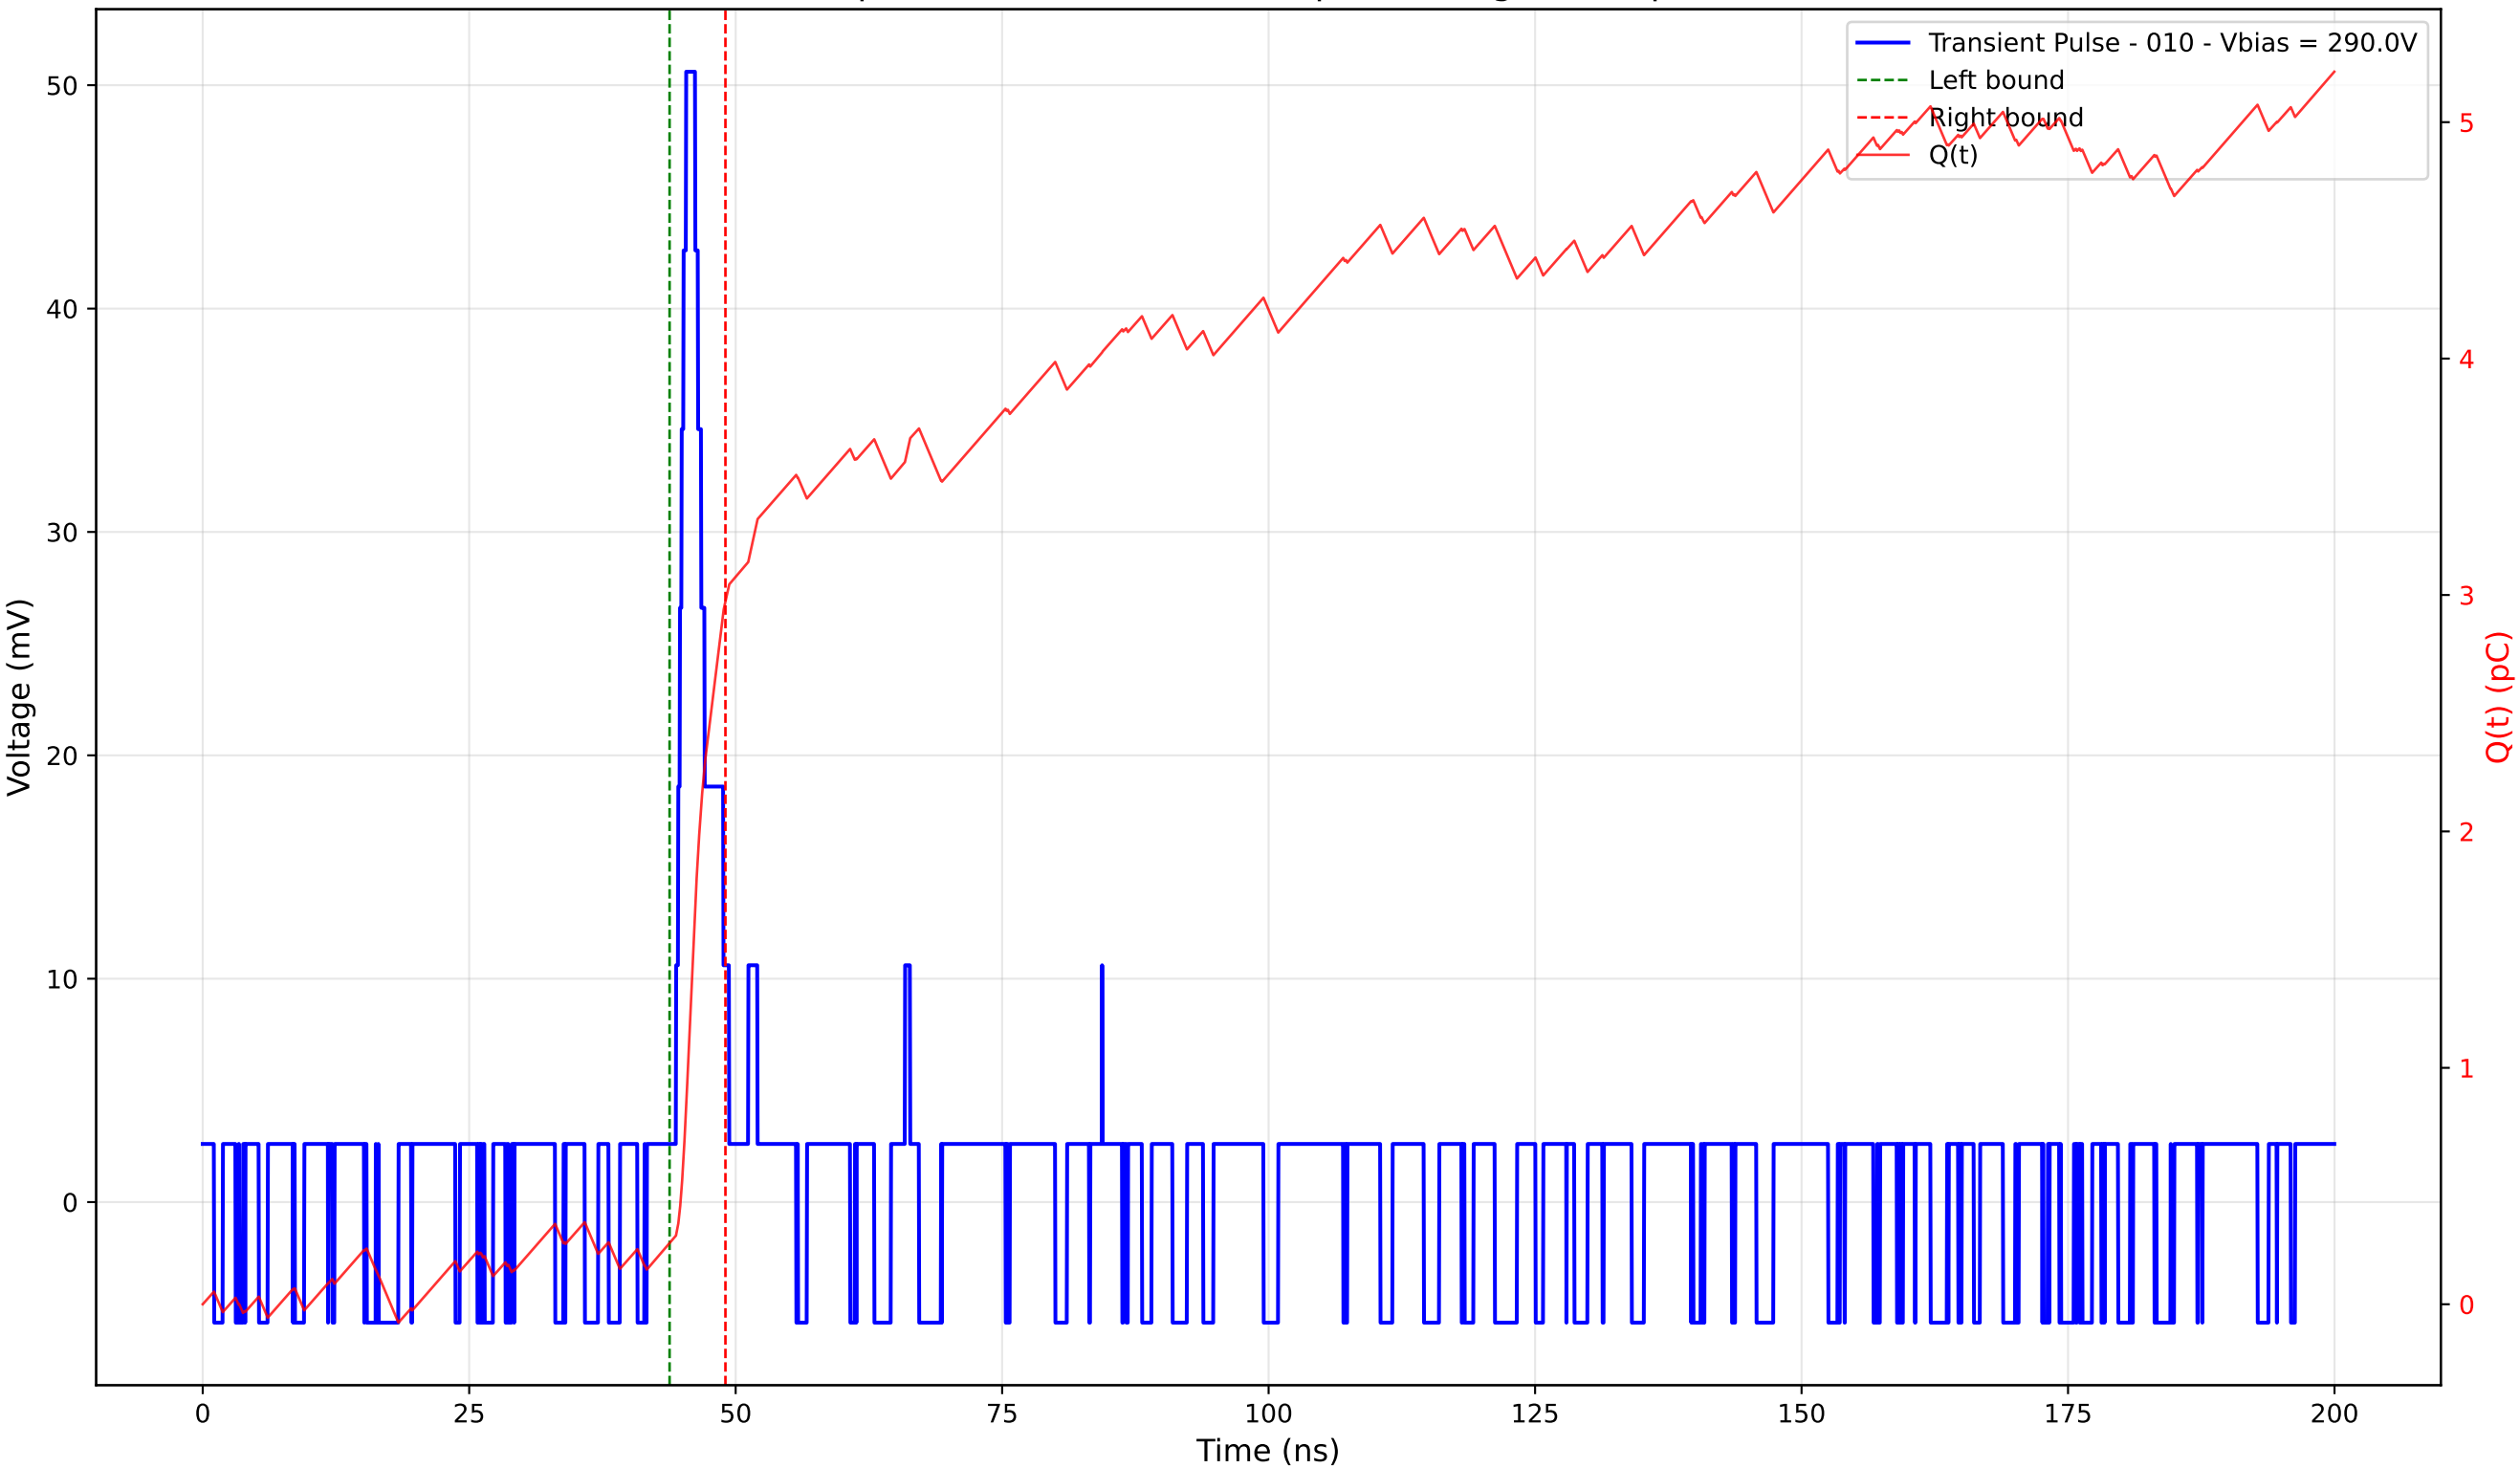


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.64 pC - Rise Time: 1.20 ns

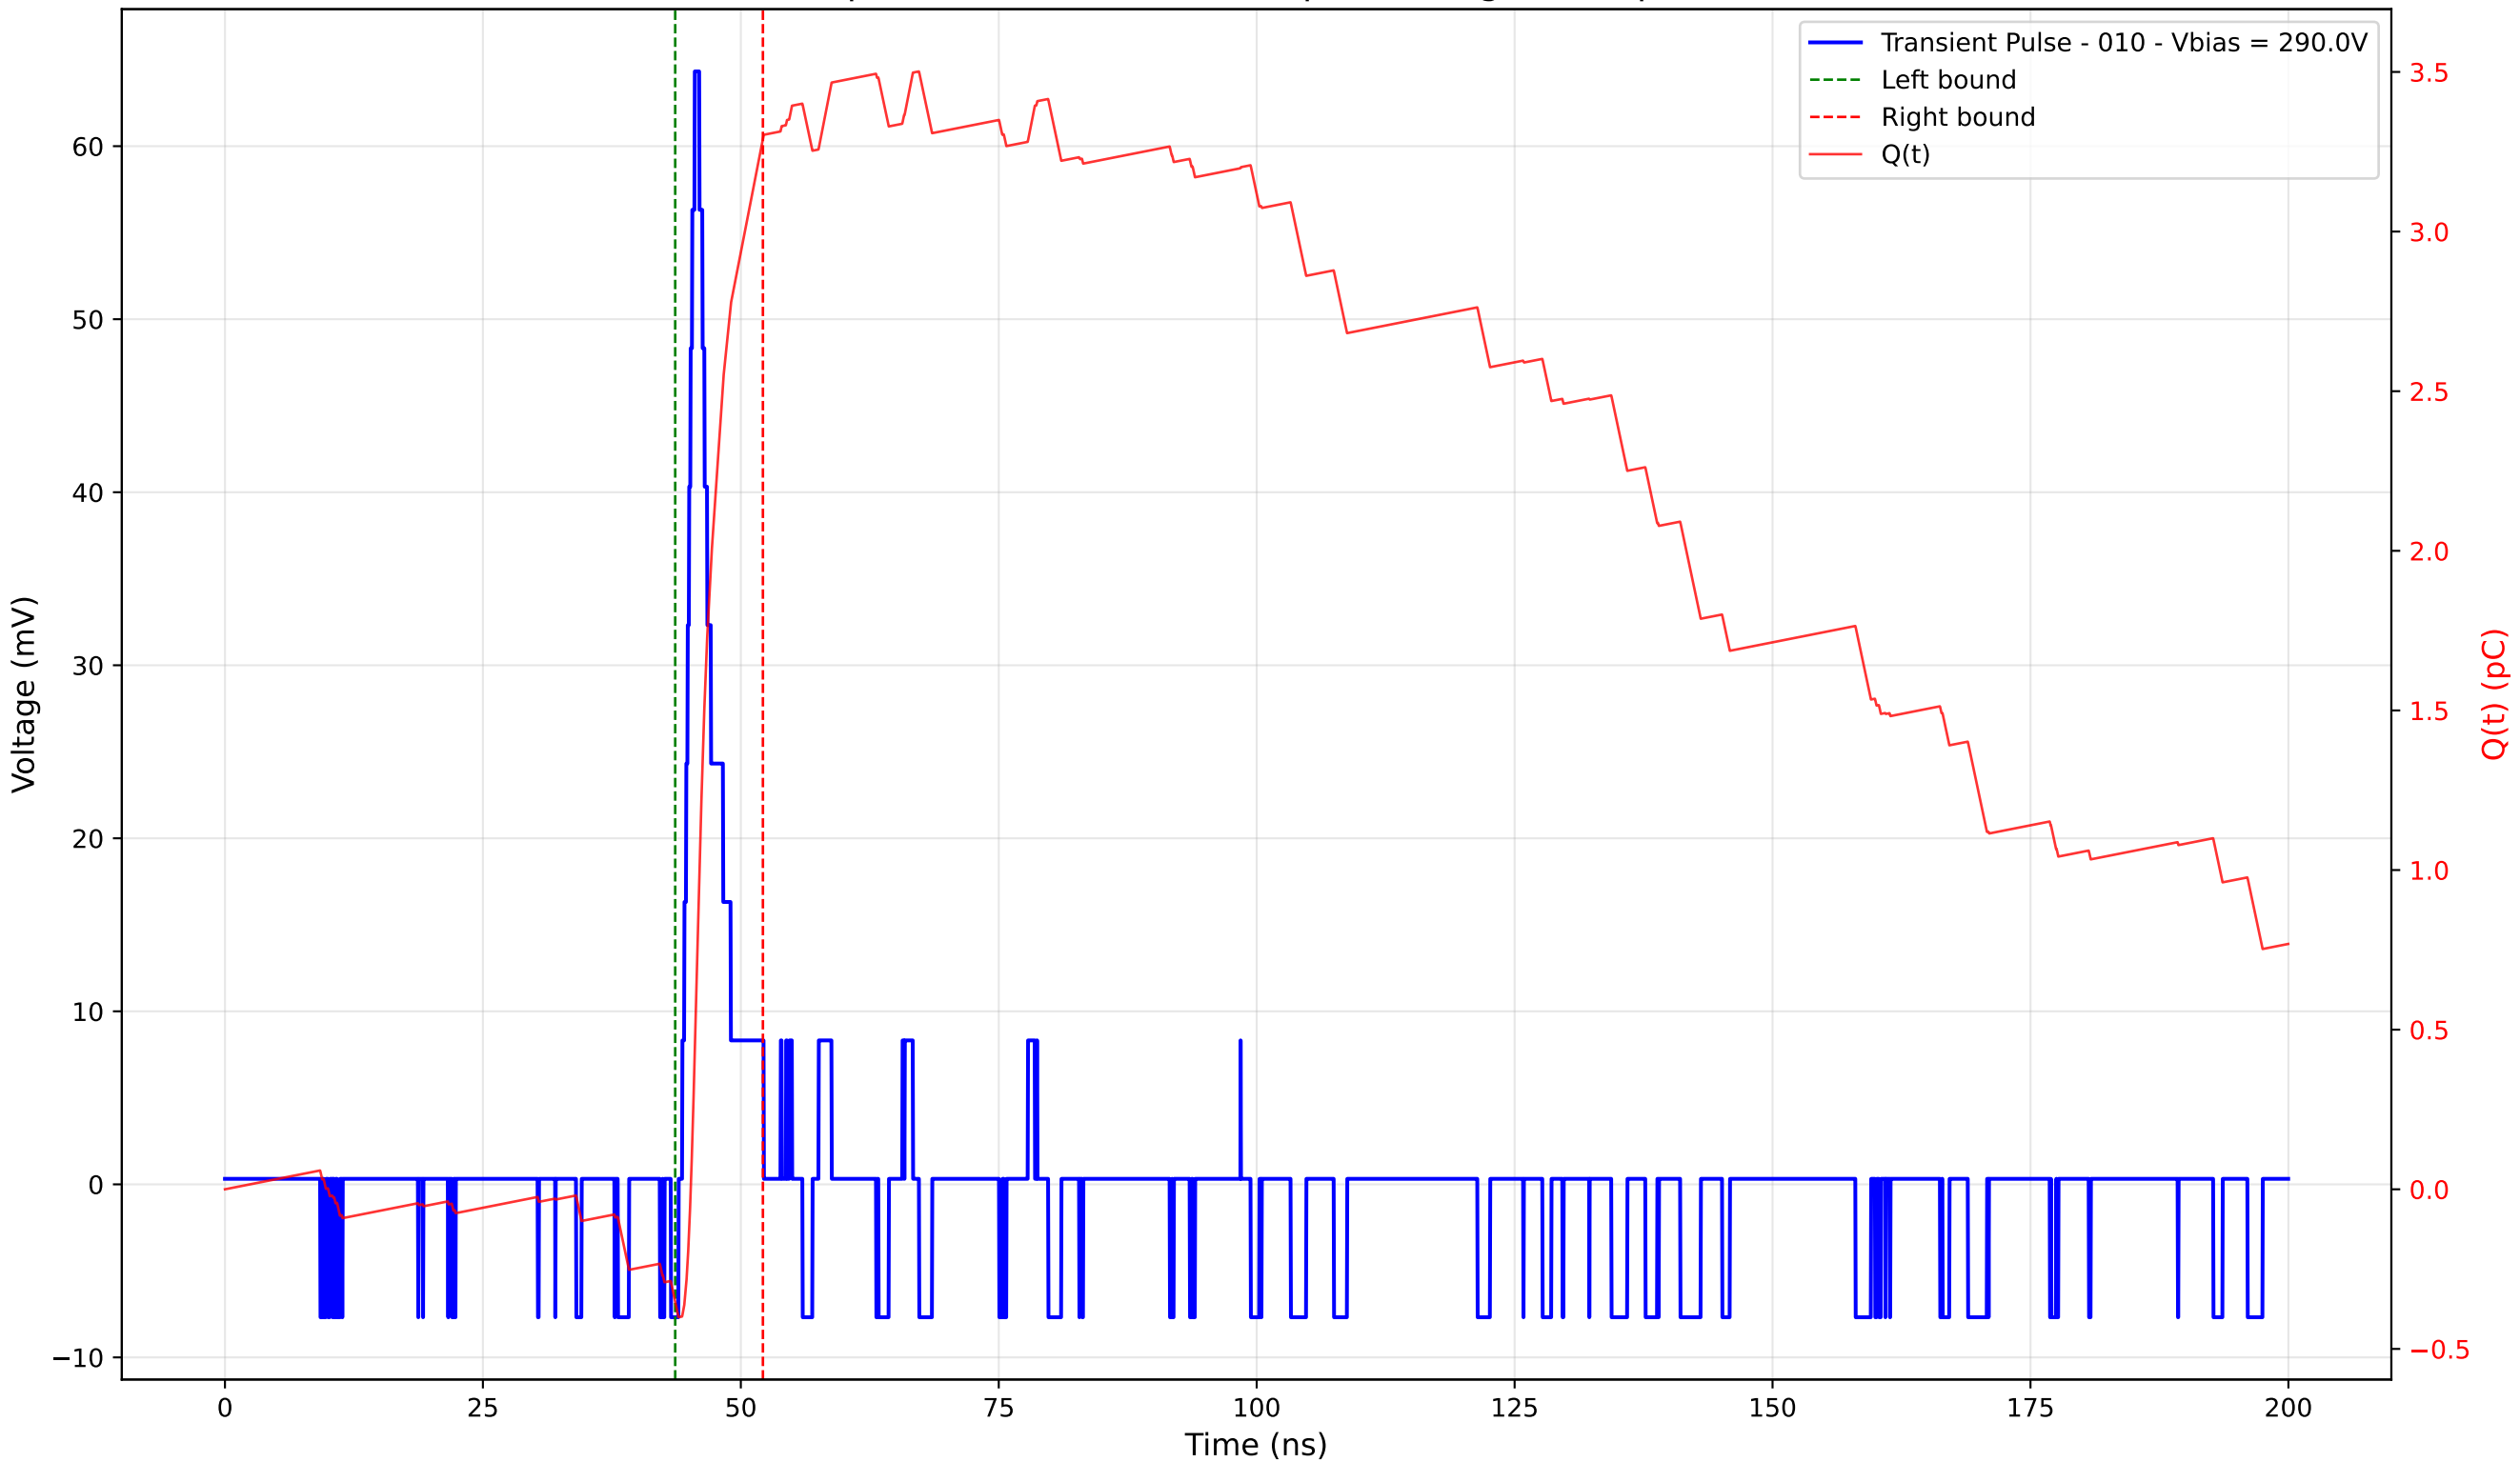


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.20 pC - Rise Time: 0.91 ns

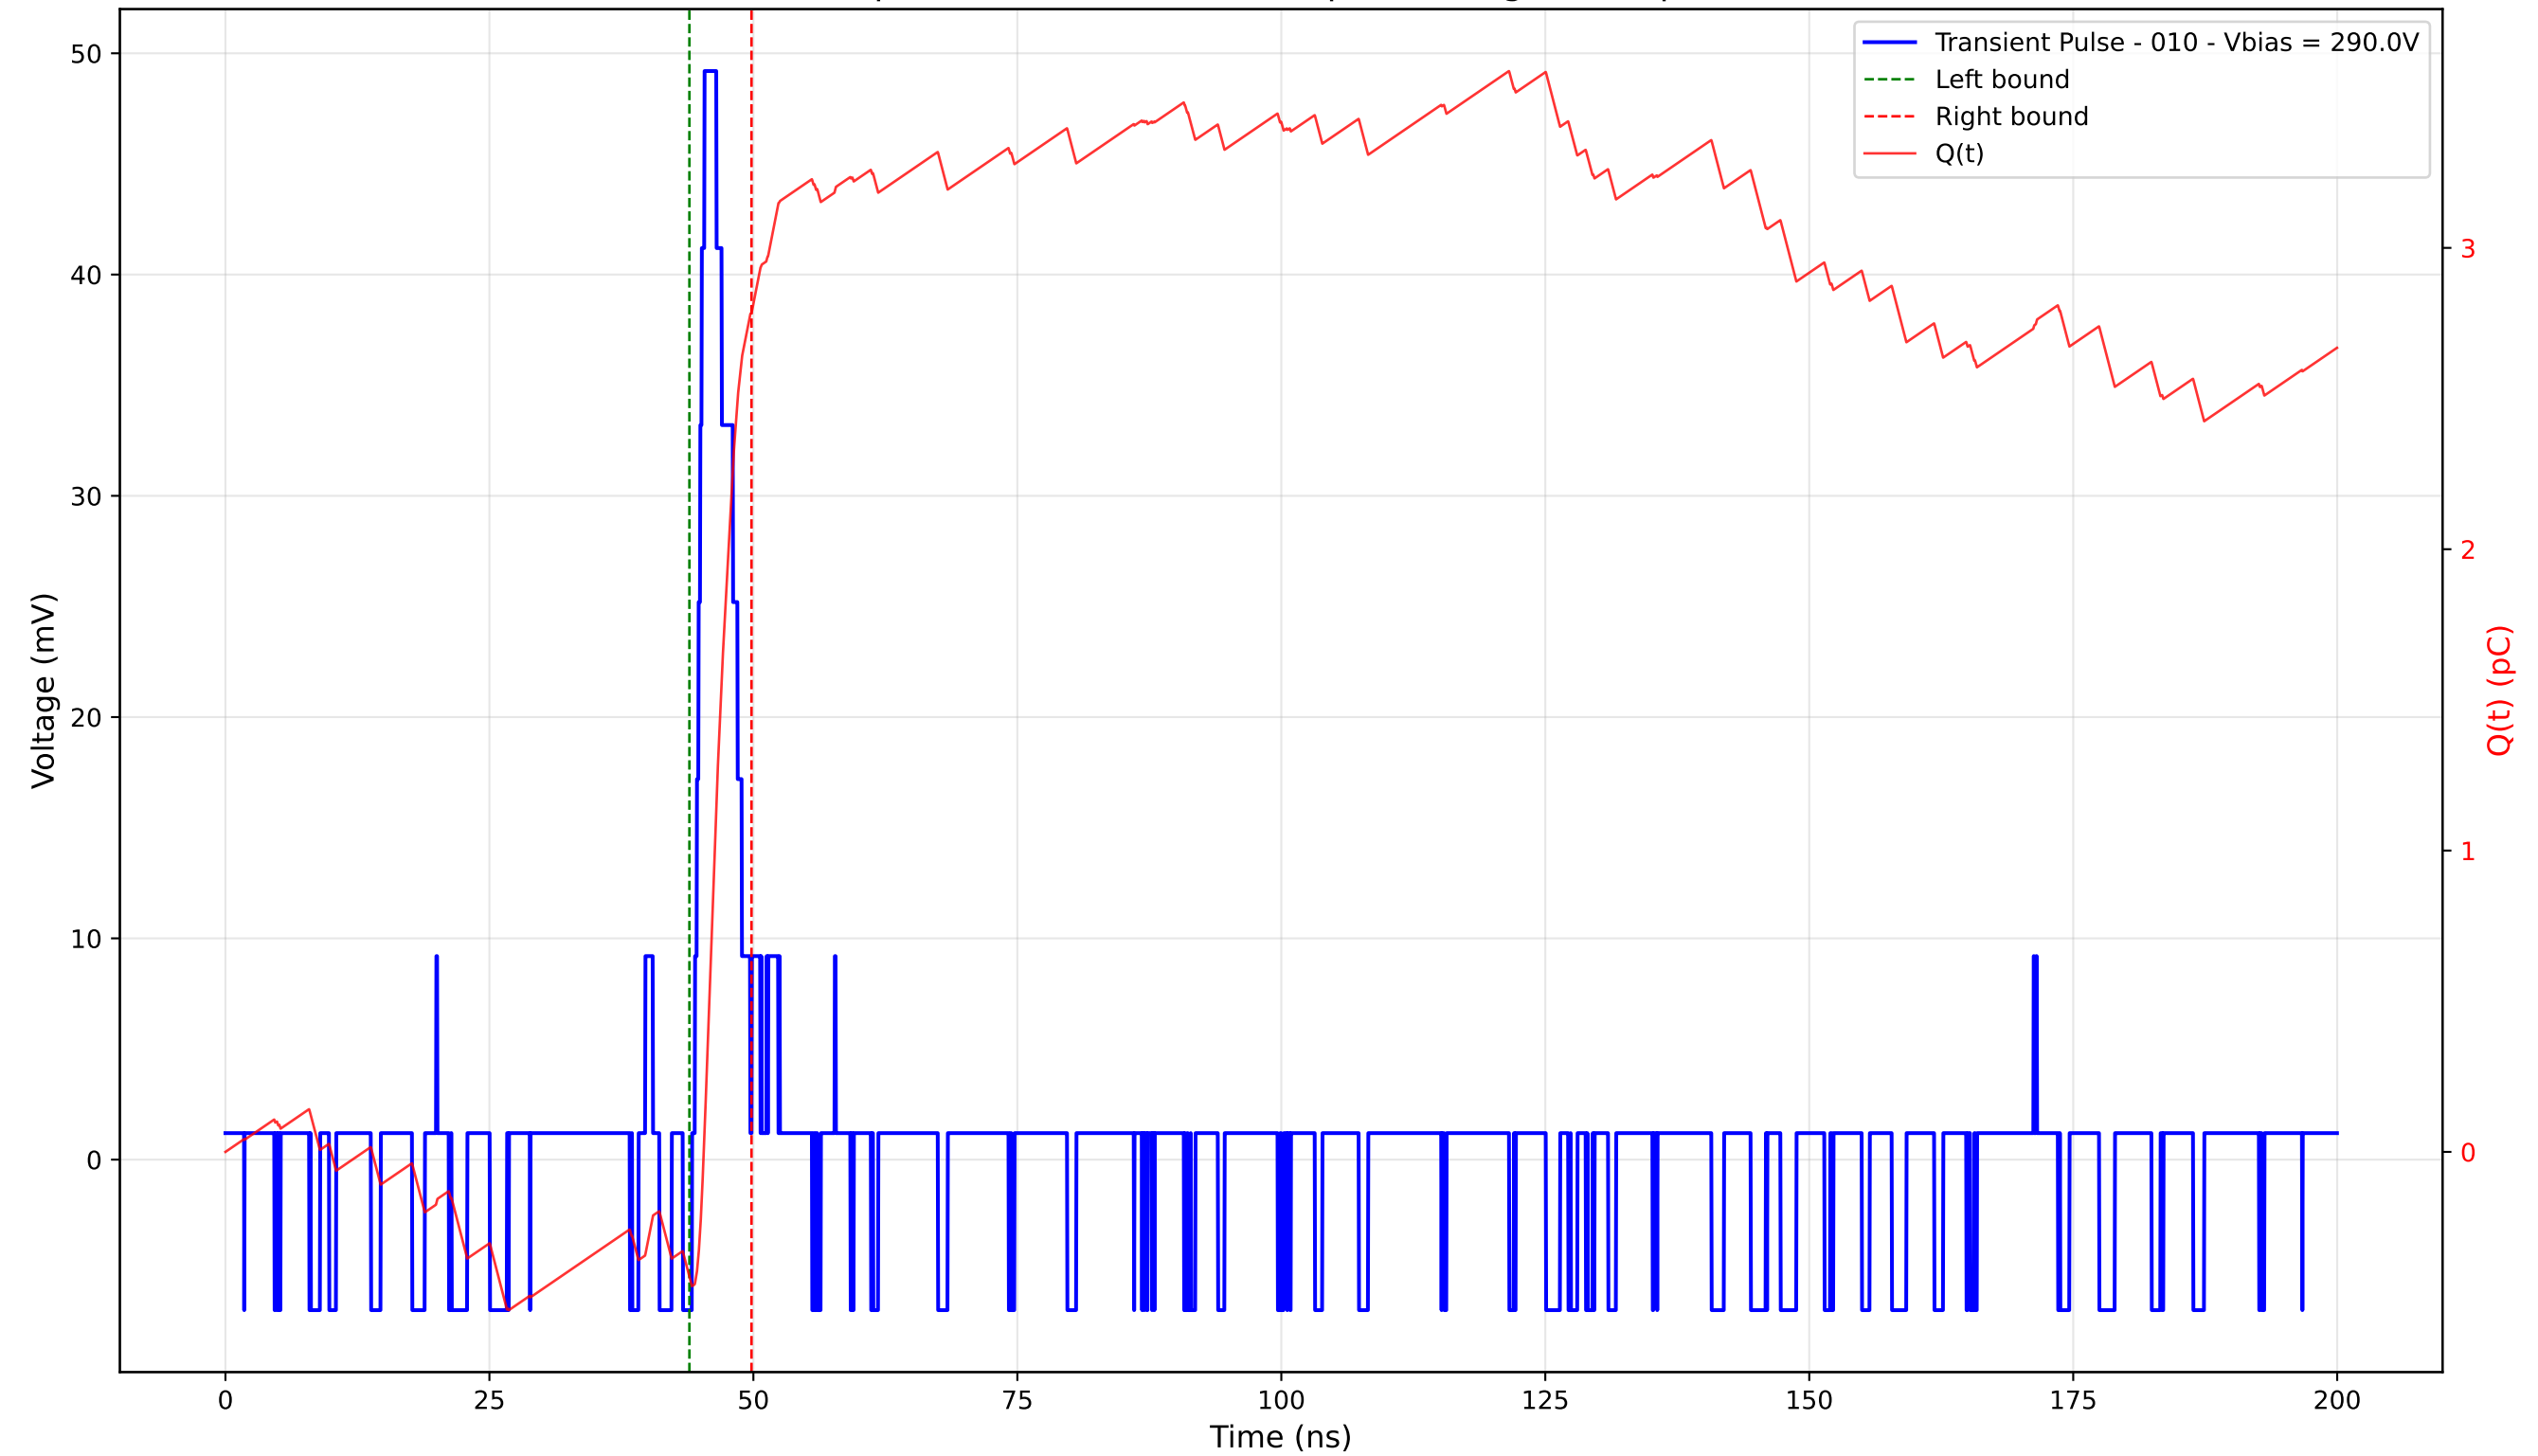


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 2.12 pC - Rise Time: 0.67 ns

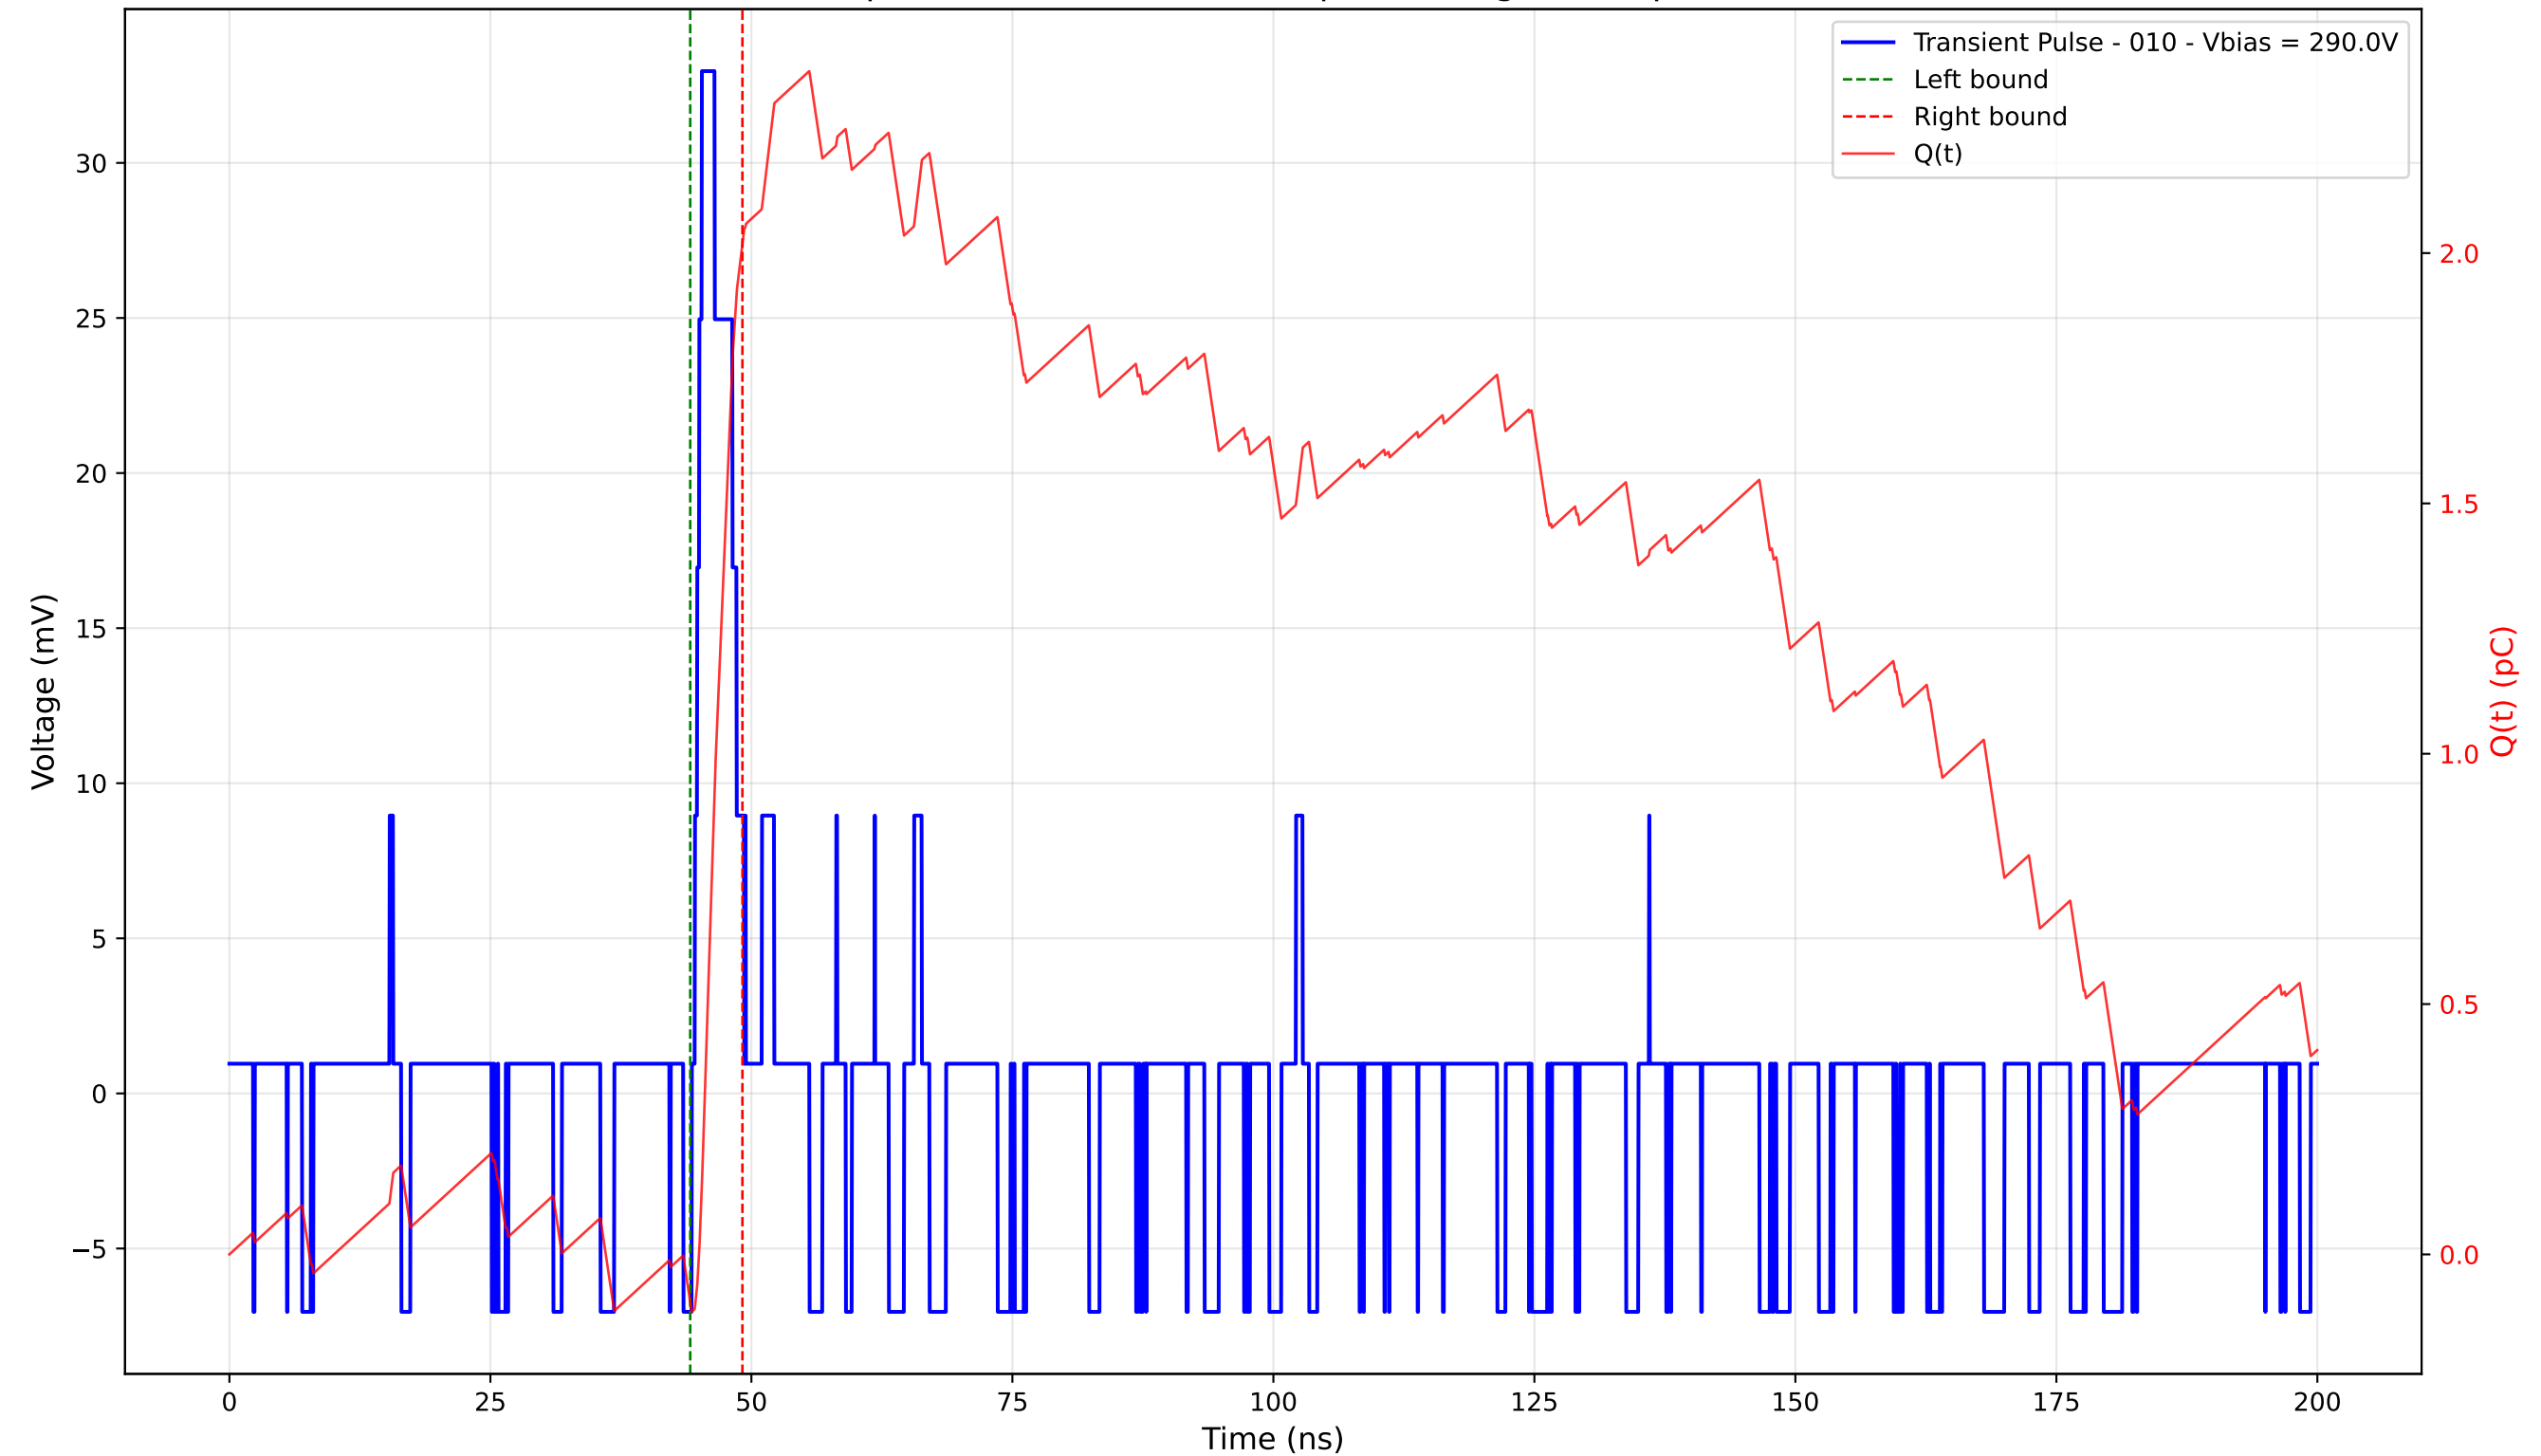


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 0.90 pC - Rise Time: 0.78 ns

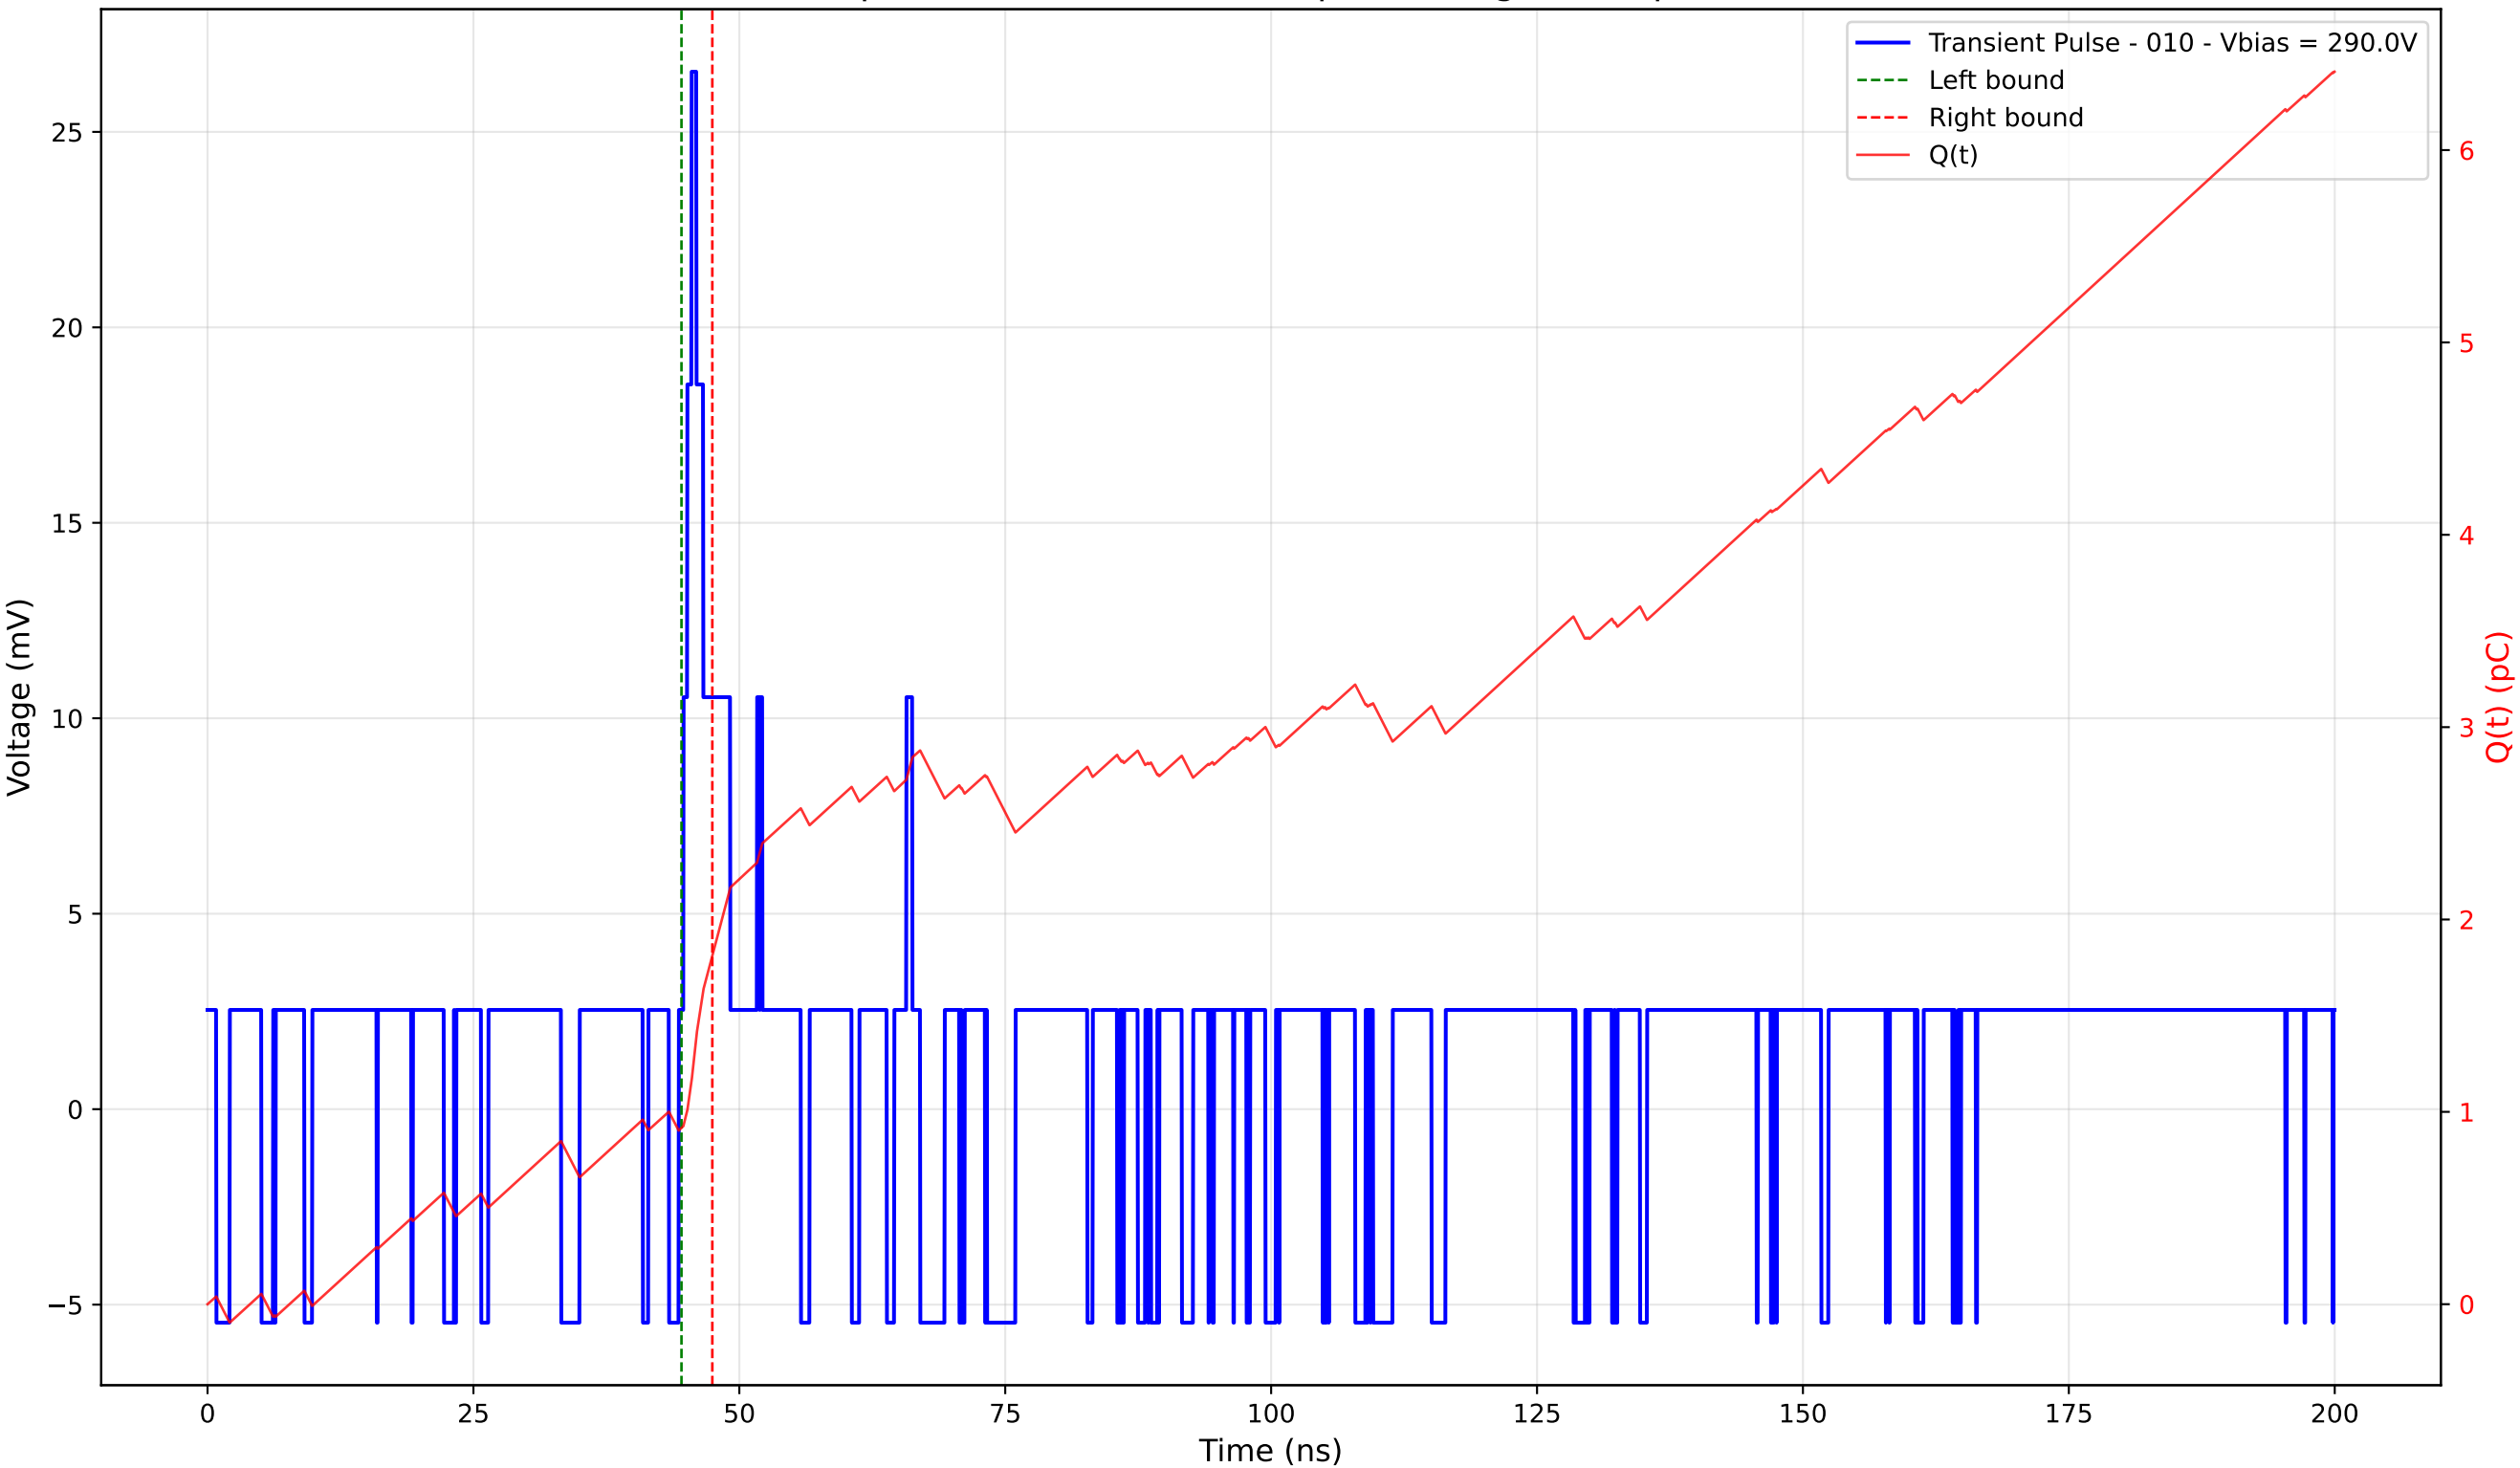


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 0.47 pC - Rise Time: 0.42 ns

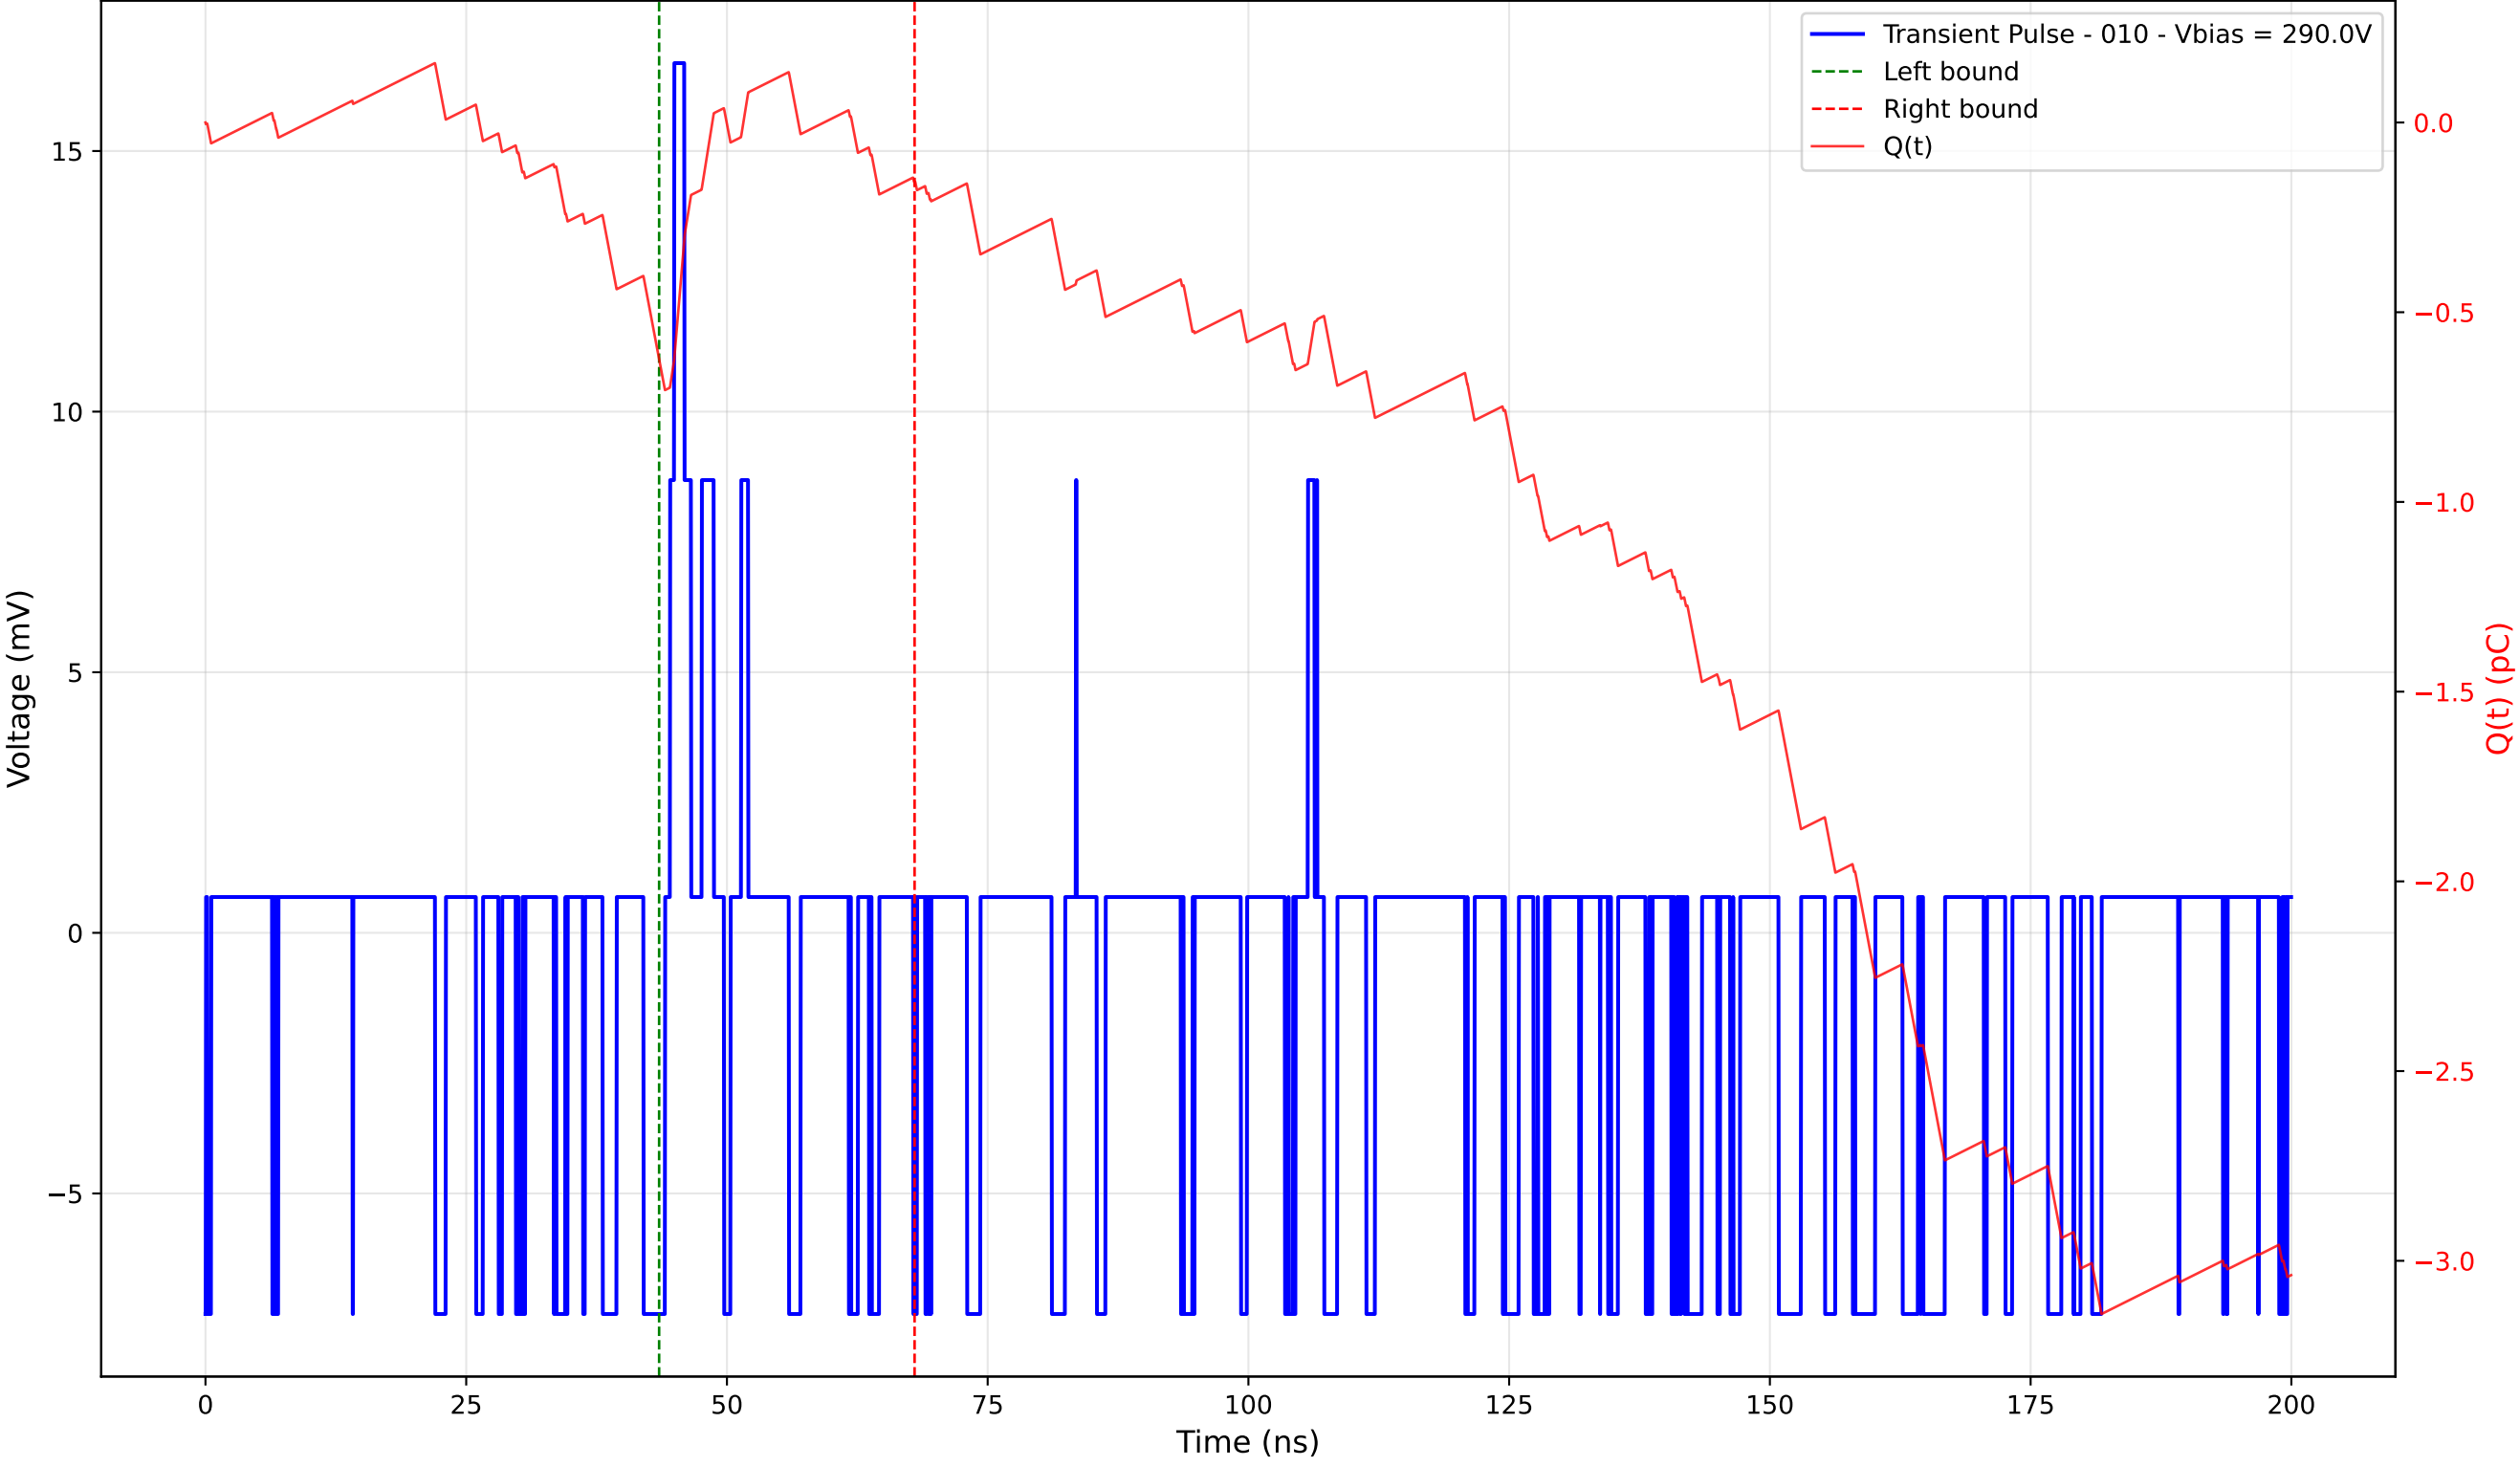


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 1.21 pC - Rise Time: 0.80 ns

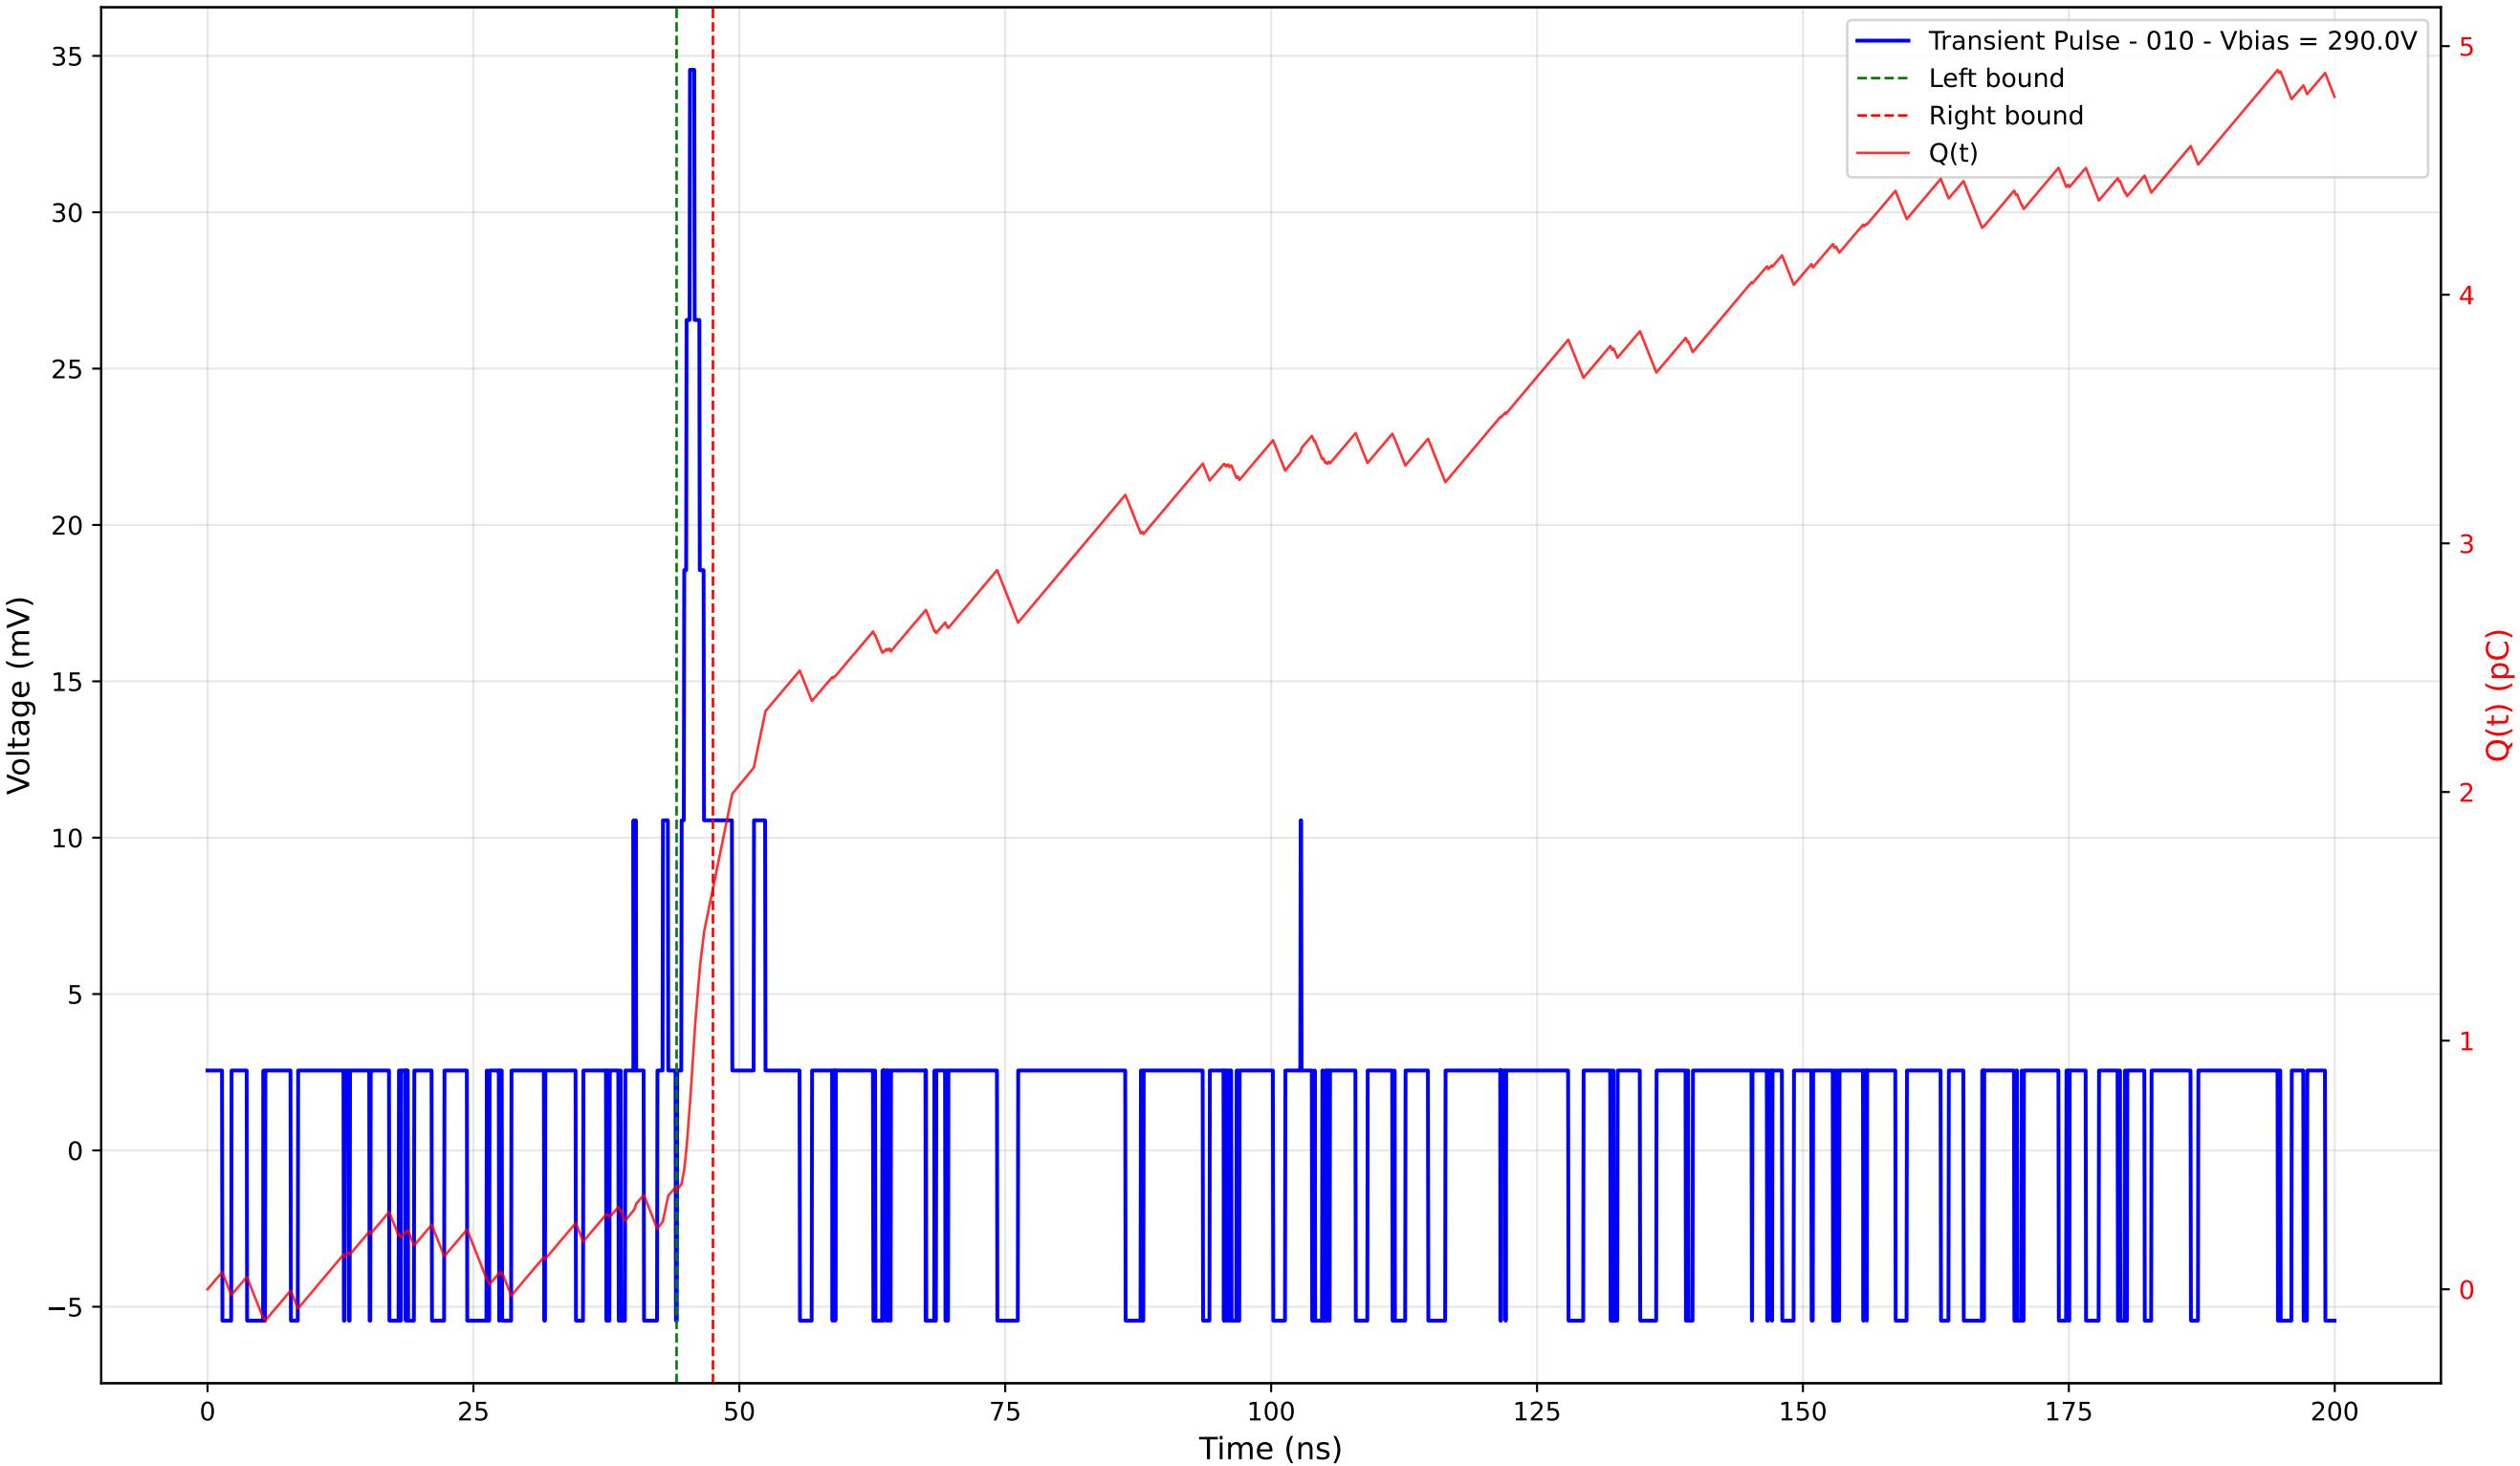


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.49 pC - Rise Time: 1.05 ns

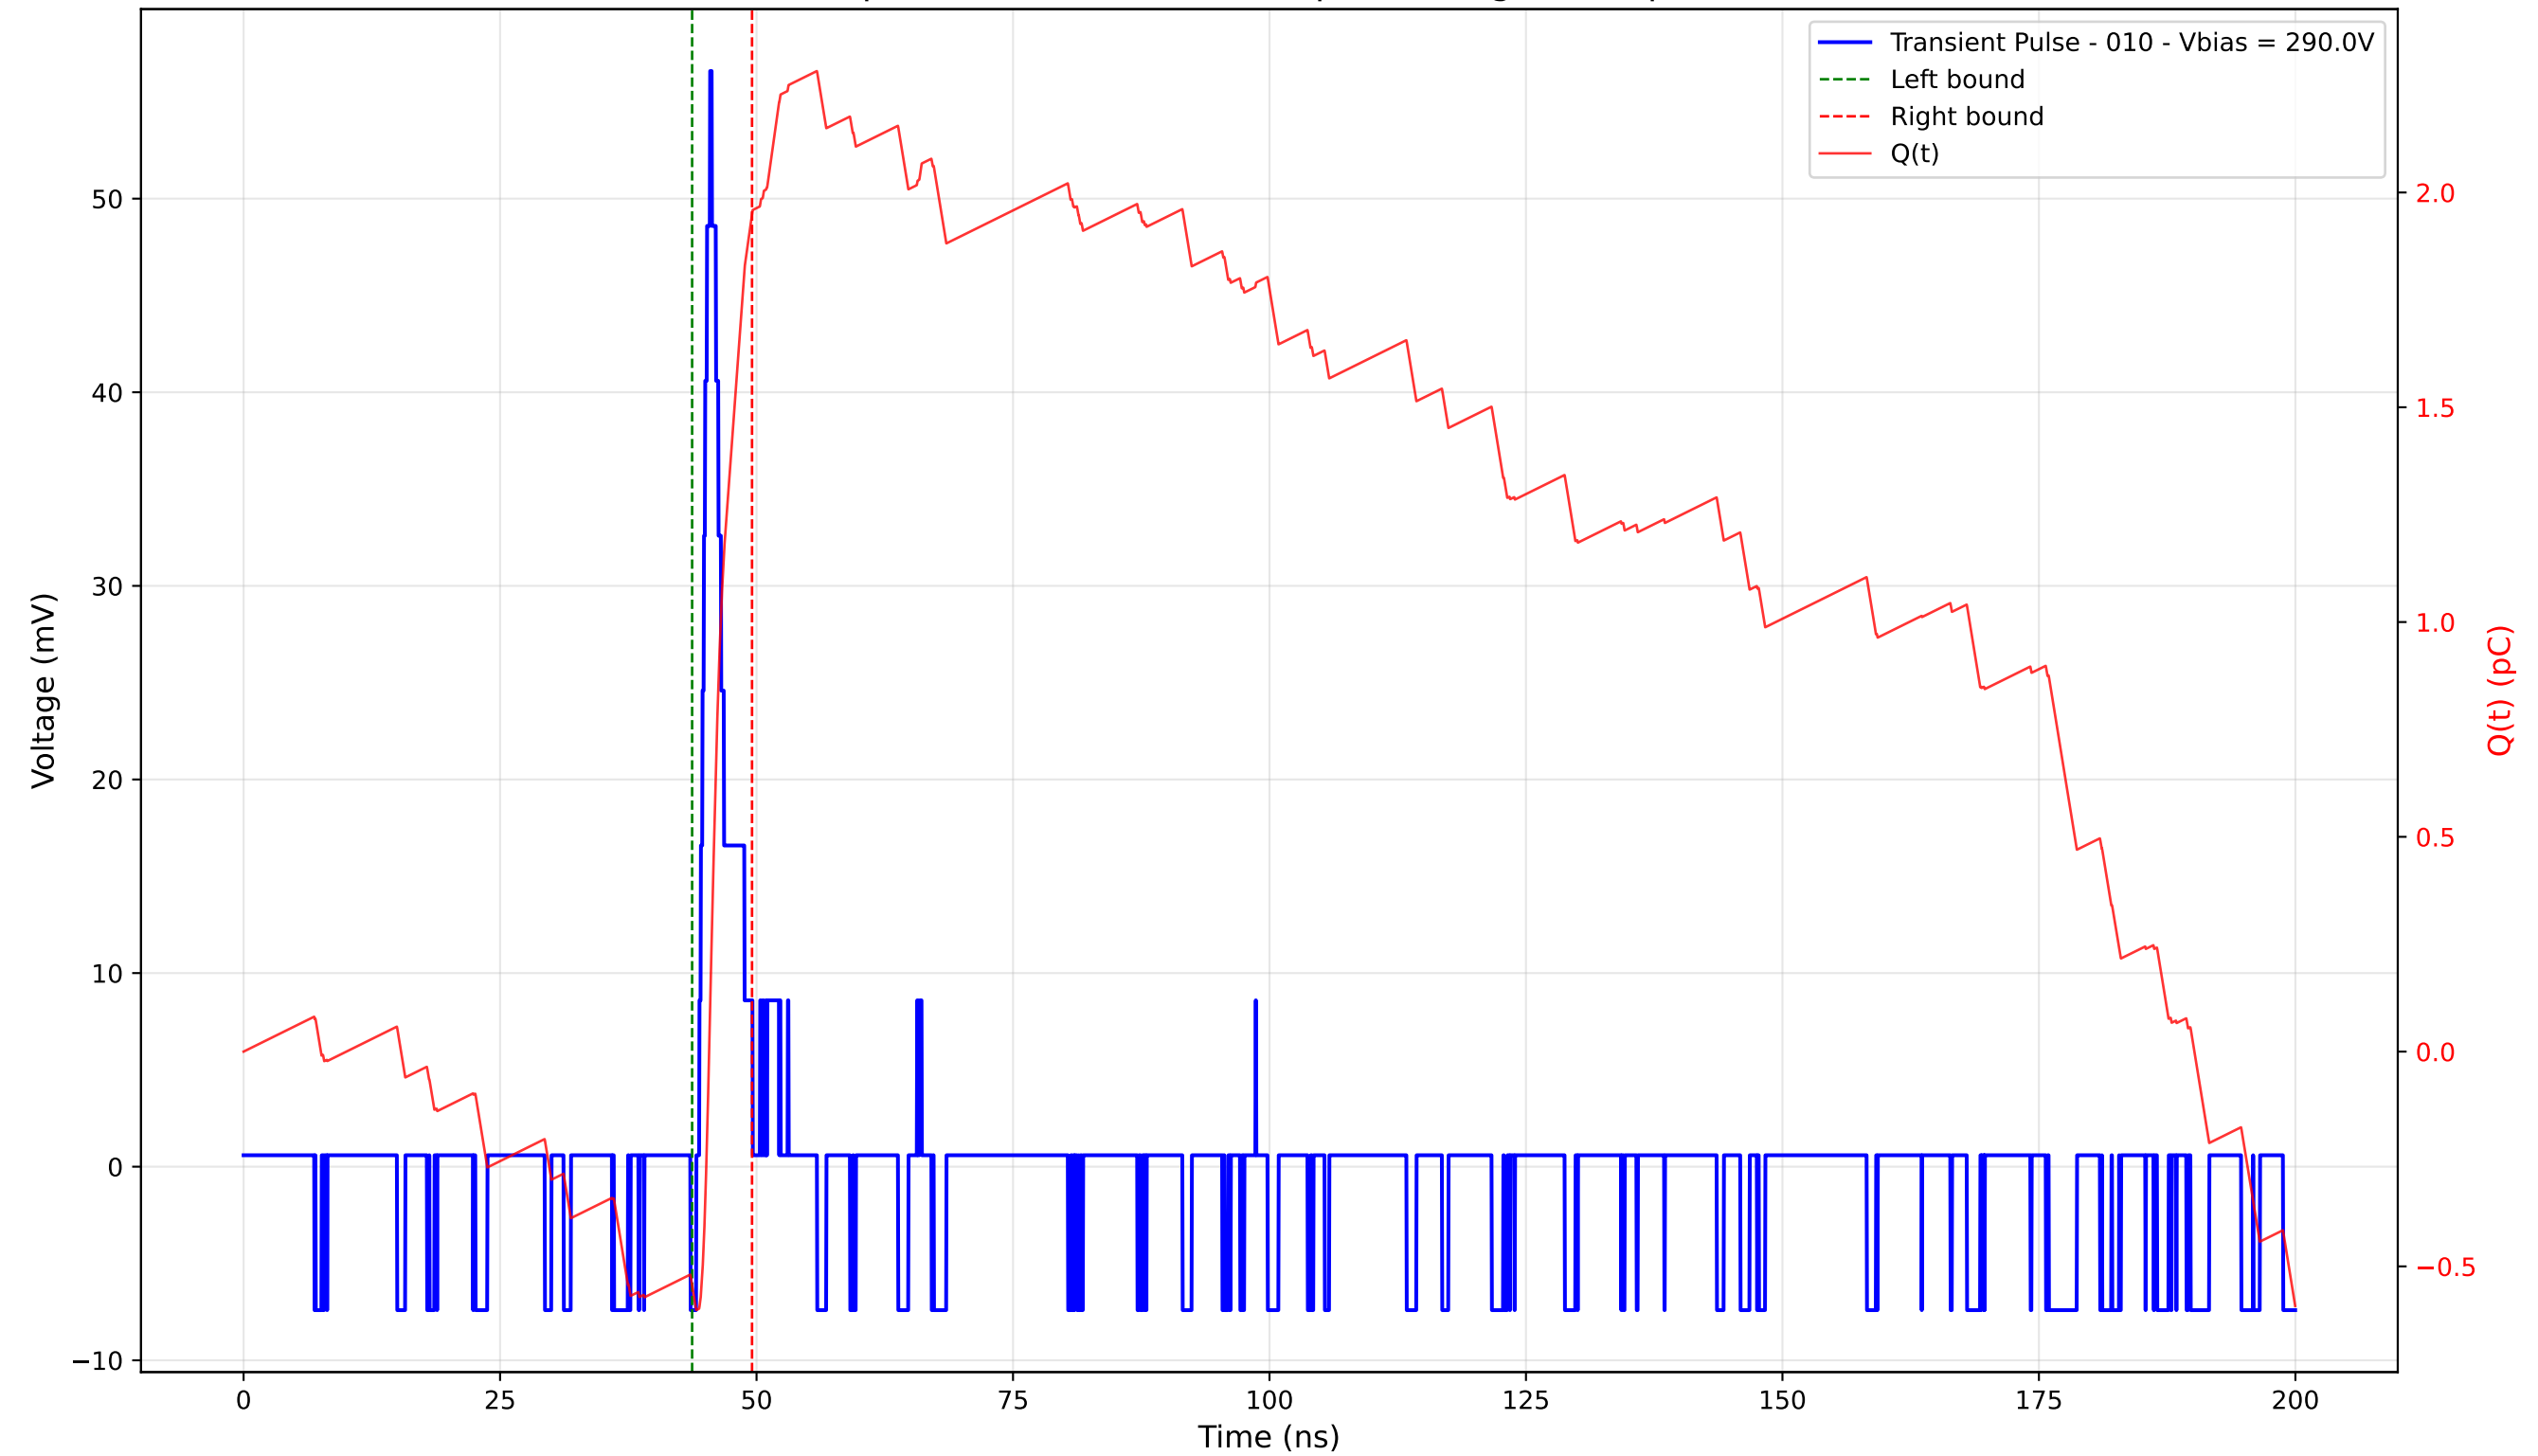


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 6.20 pC - Rise Time: 0.86 ns

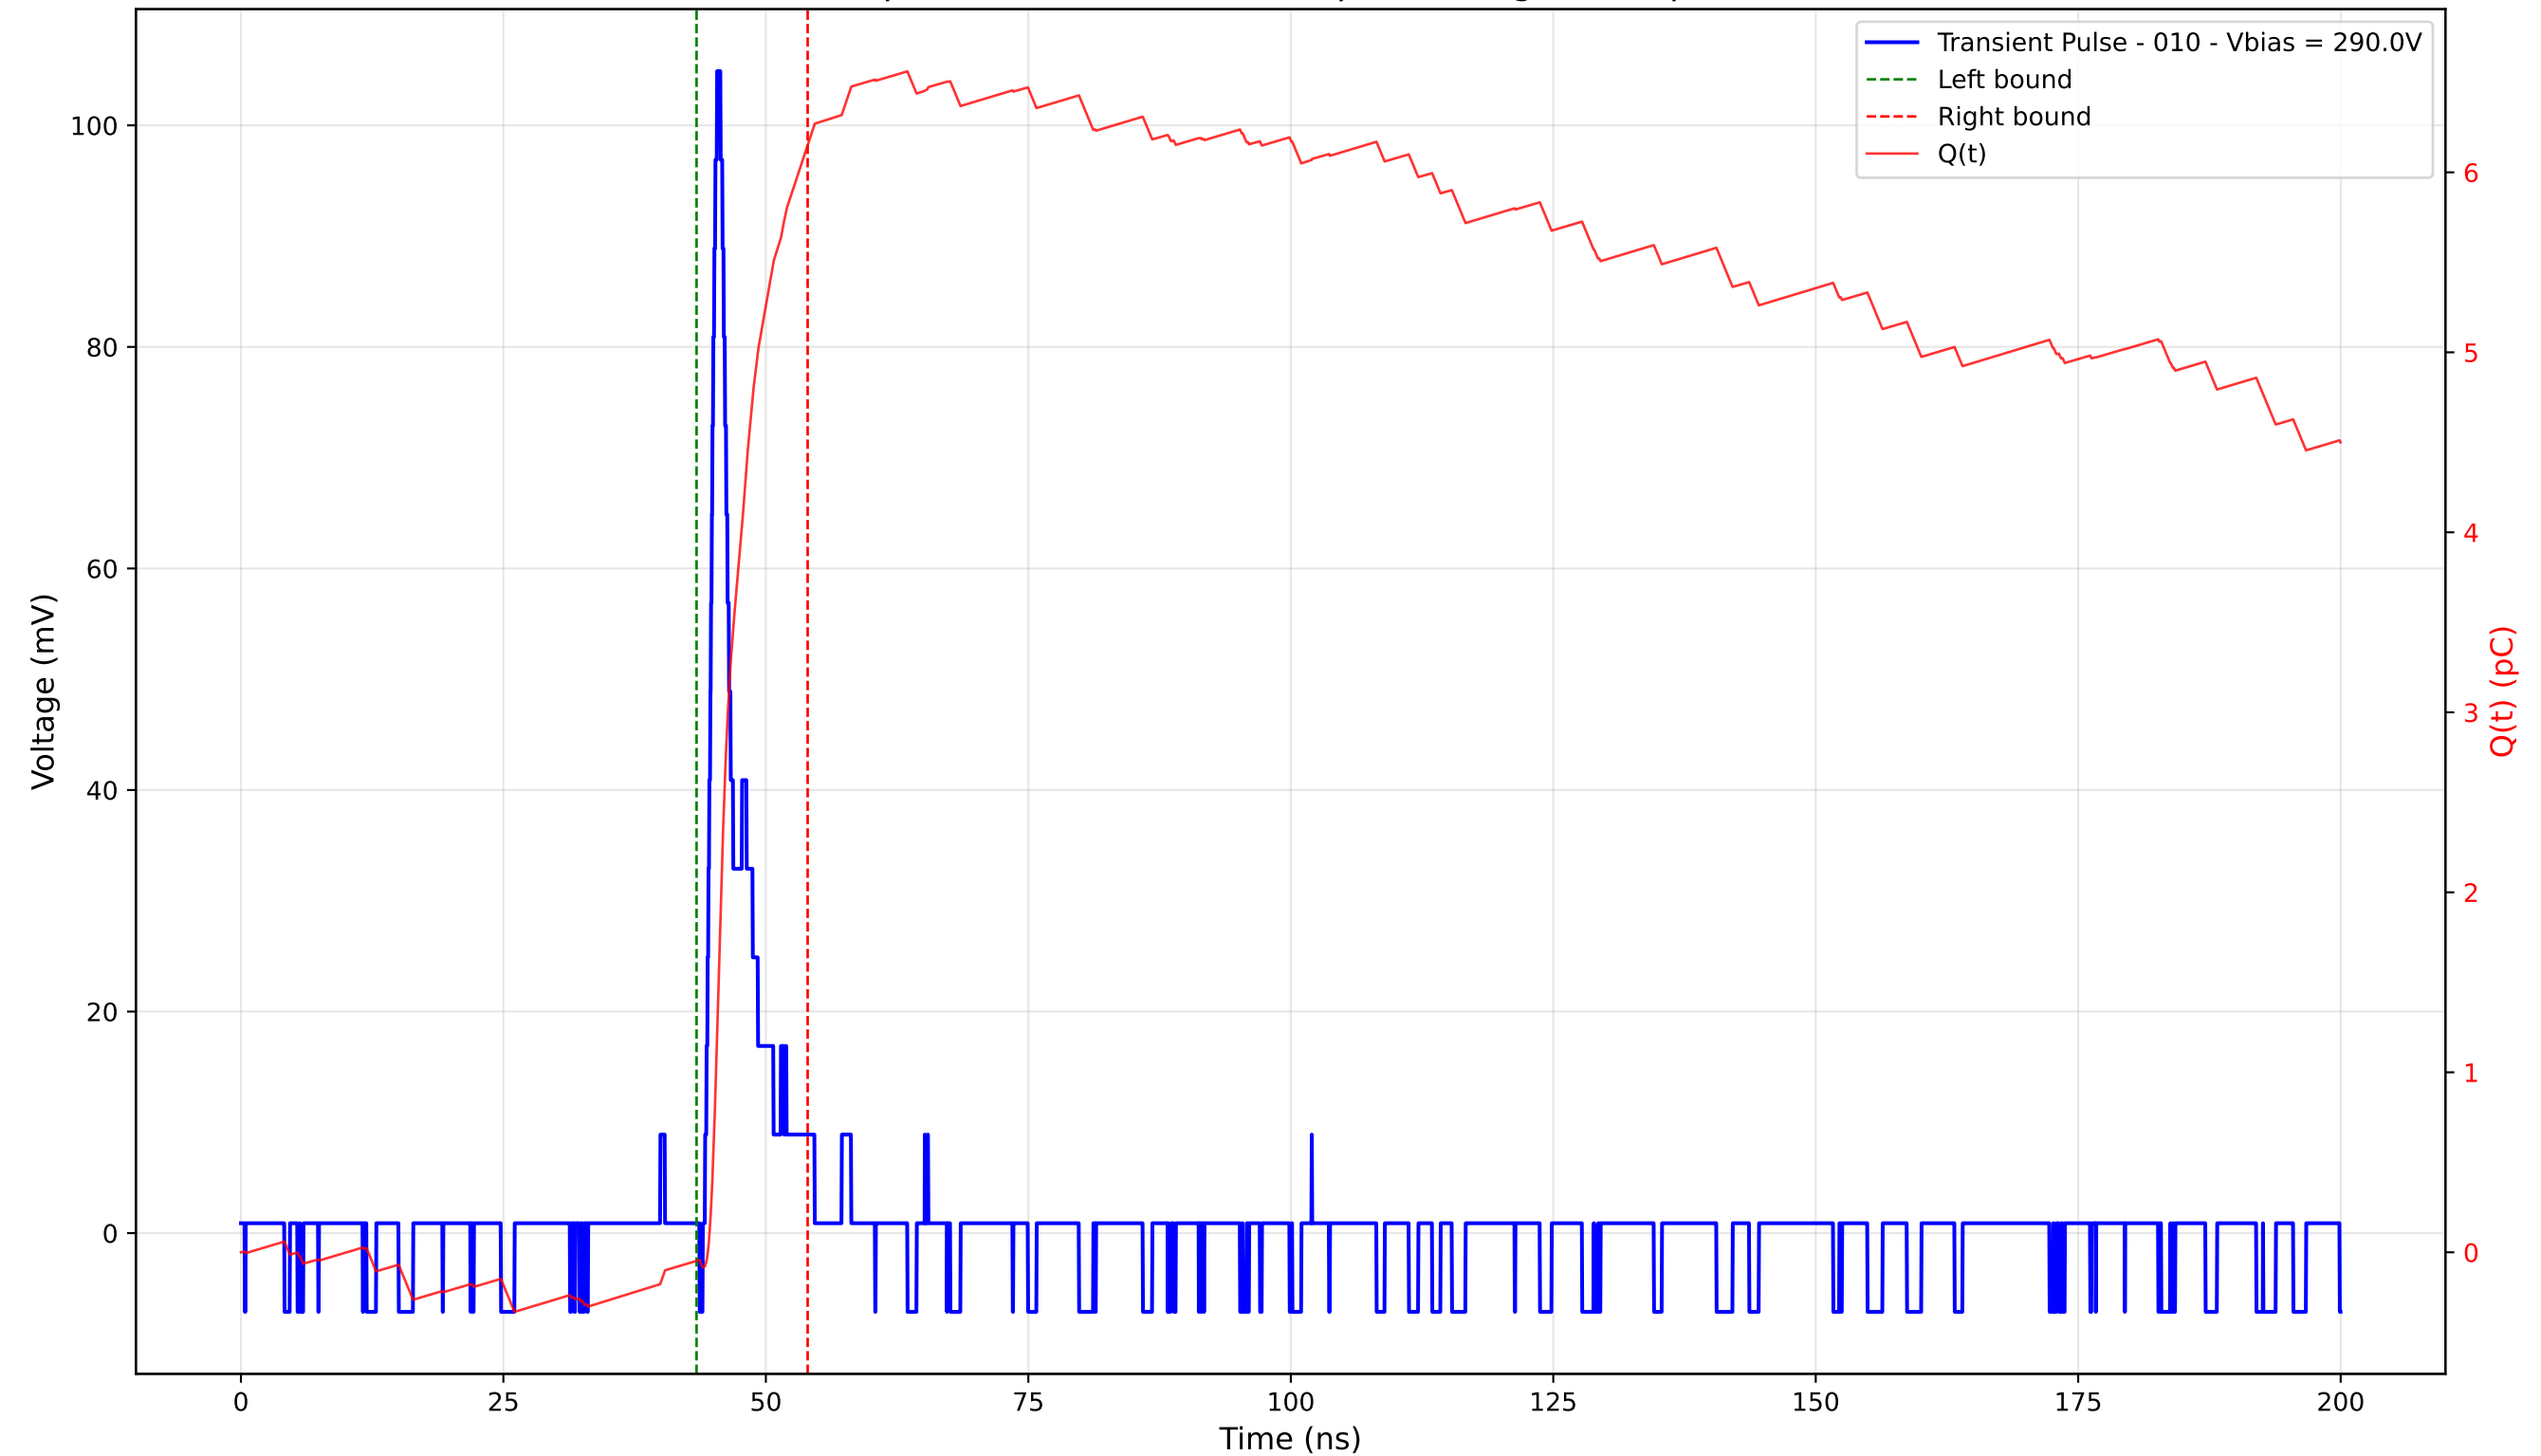


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 10.42 pC - Rise Time: 0.86 ns

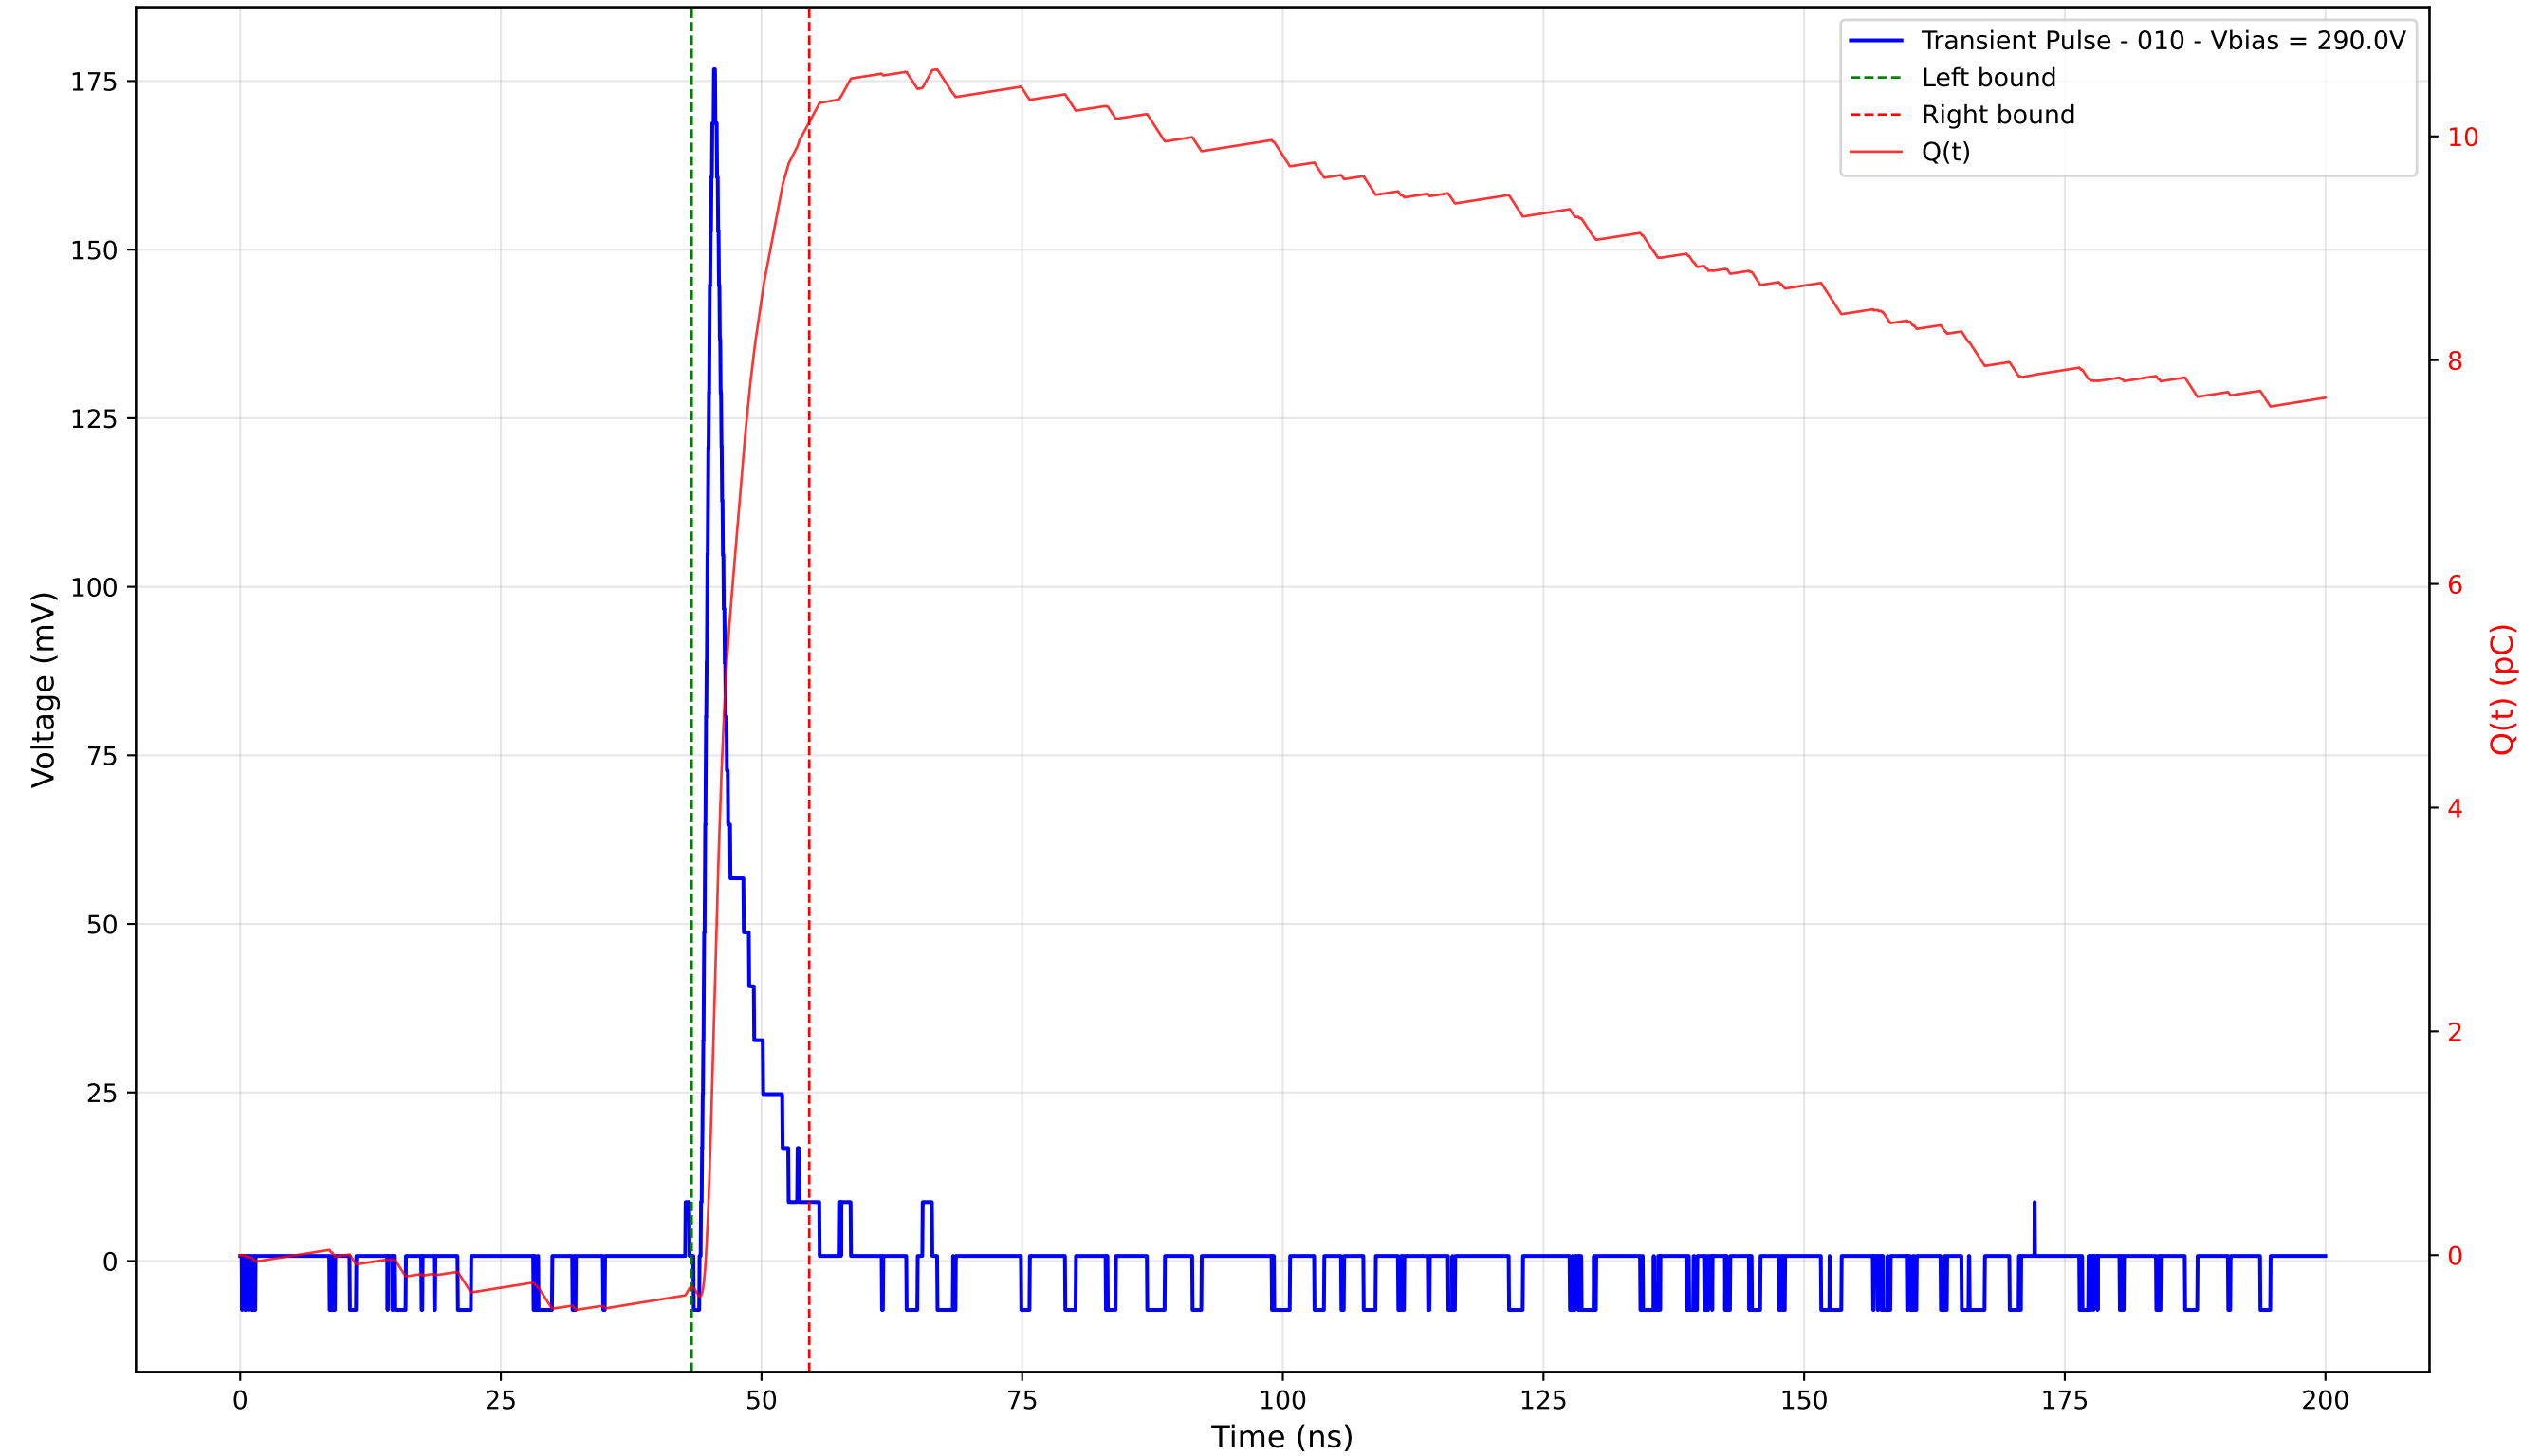


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 15.97 pC - Rise Time: 0.86 ns

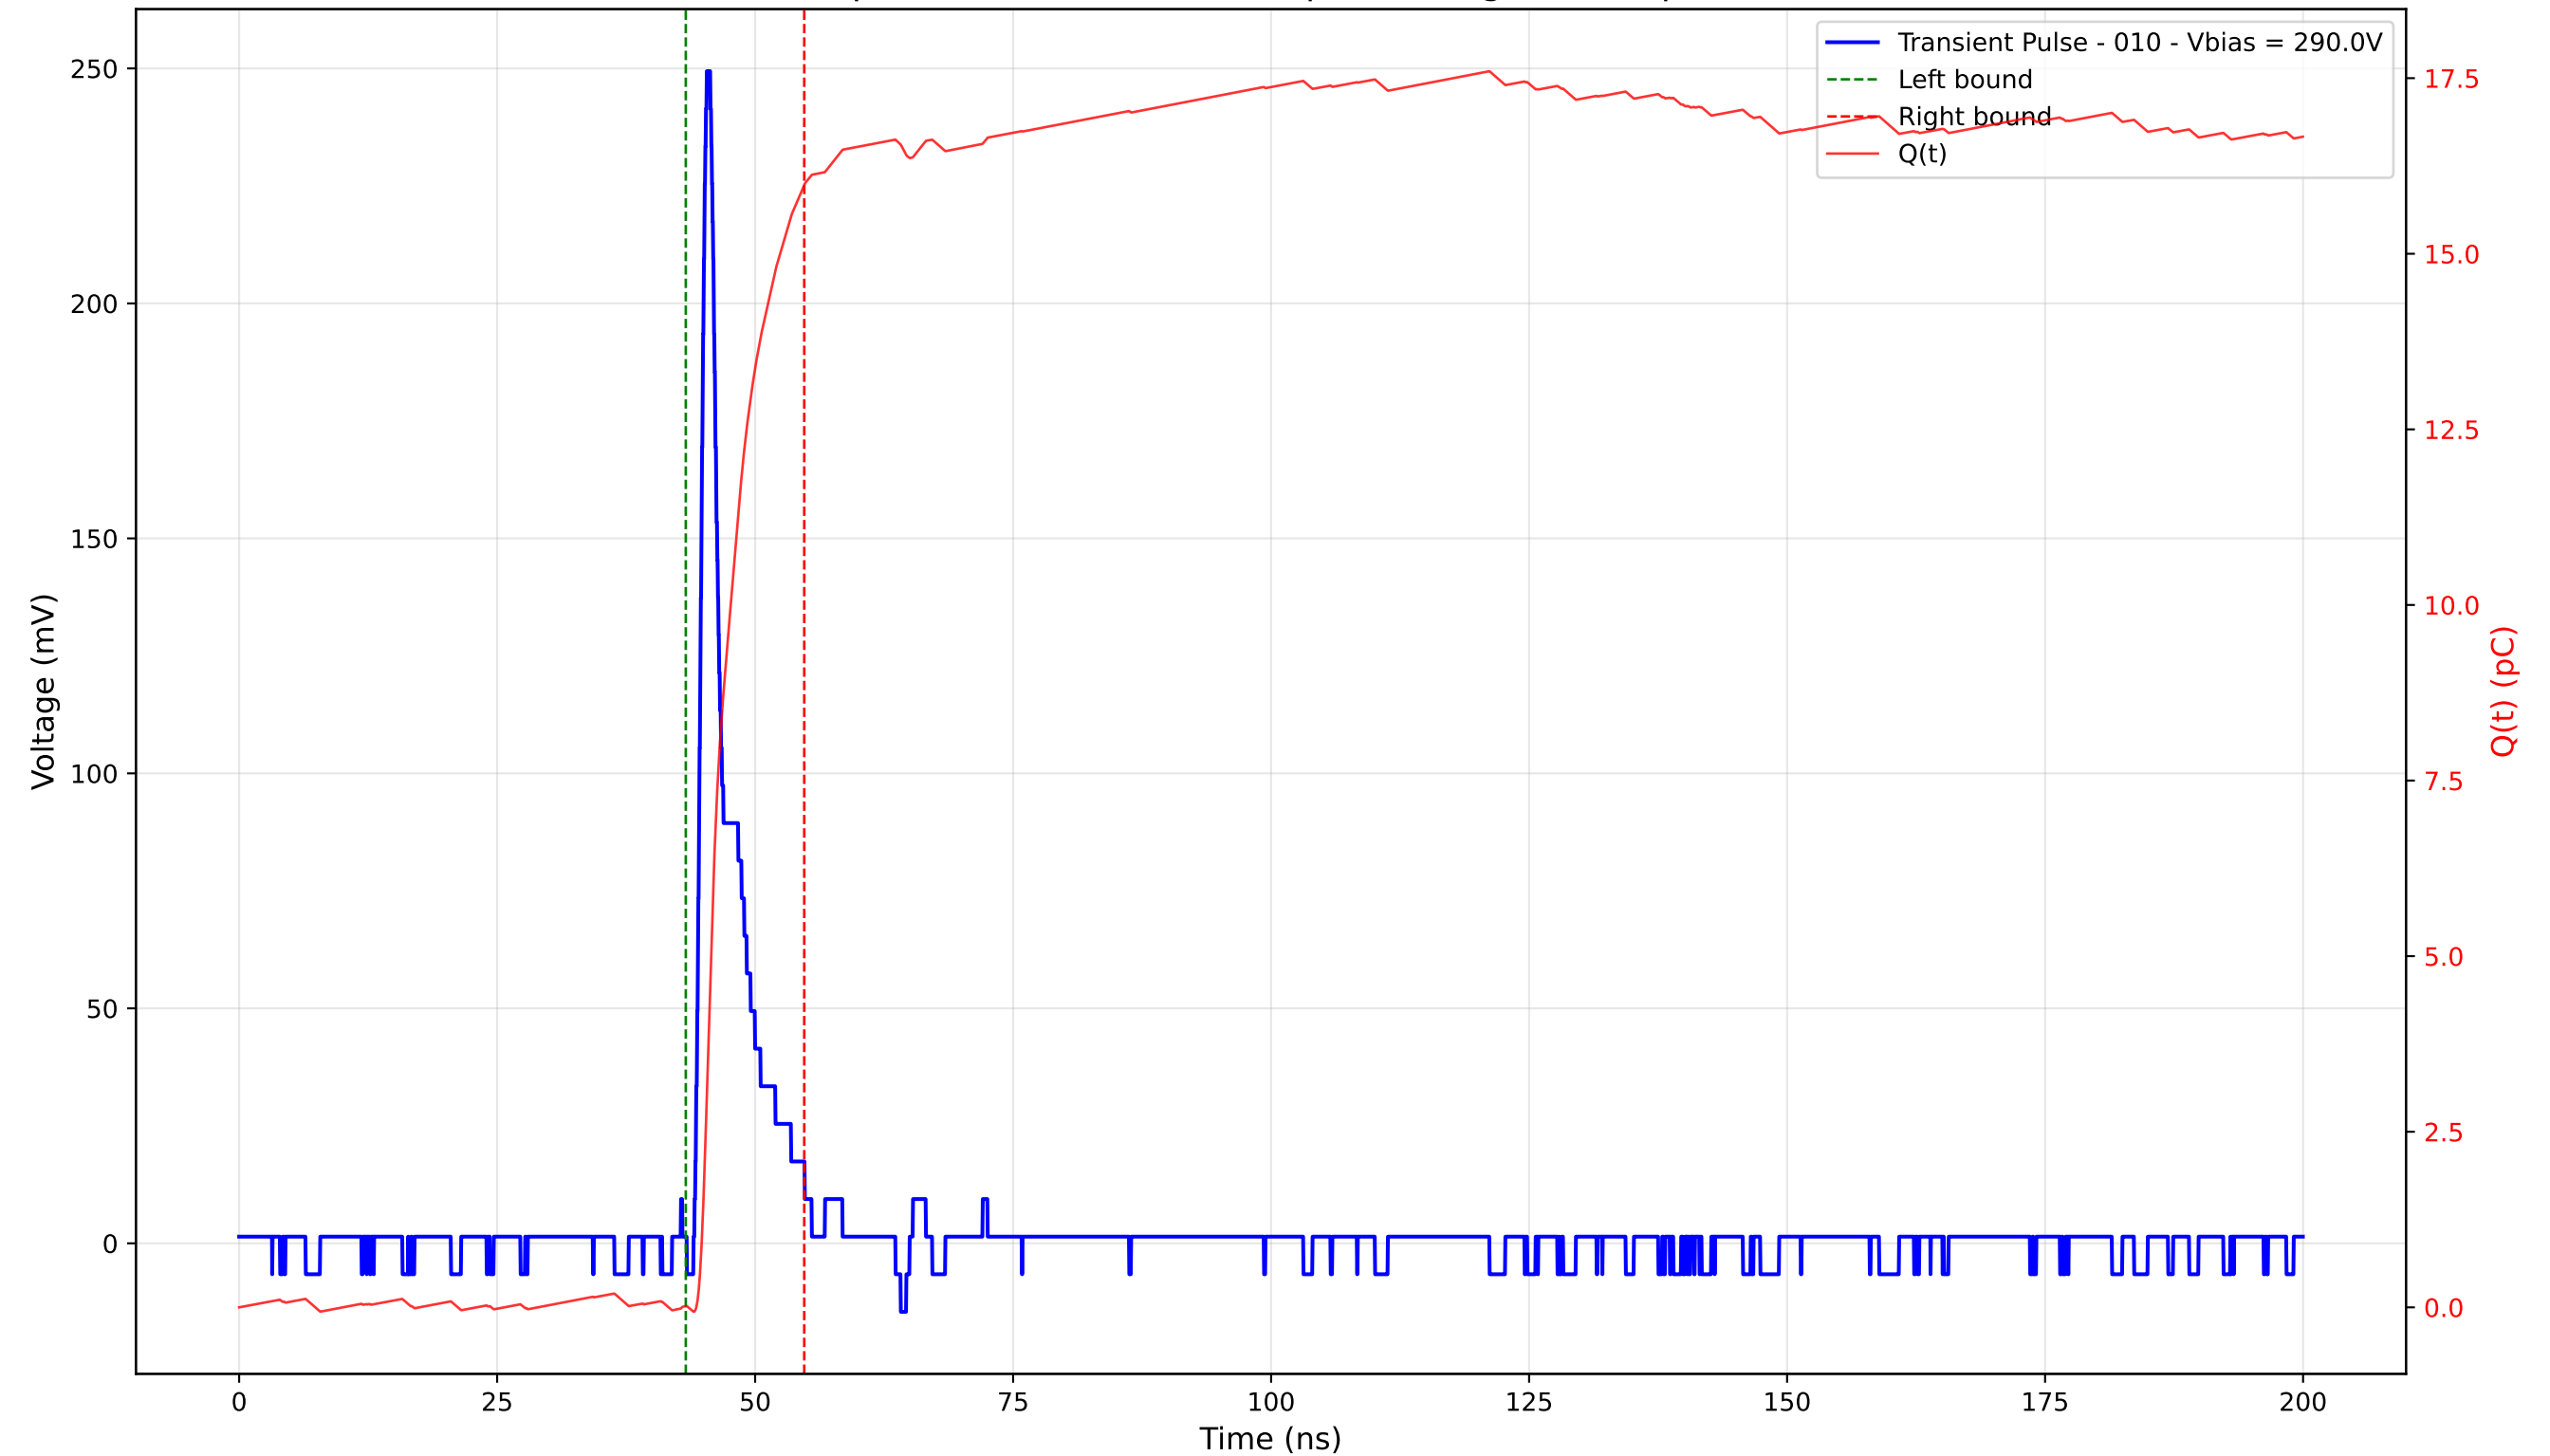


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 20.83 pC - Rise Time: 0.90 ns

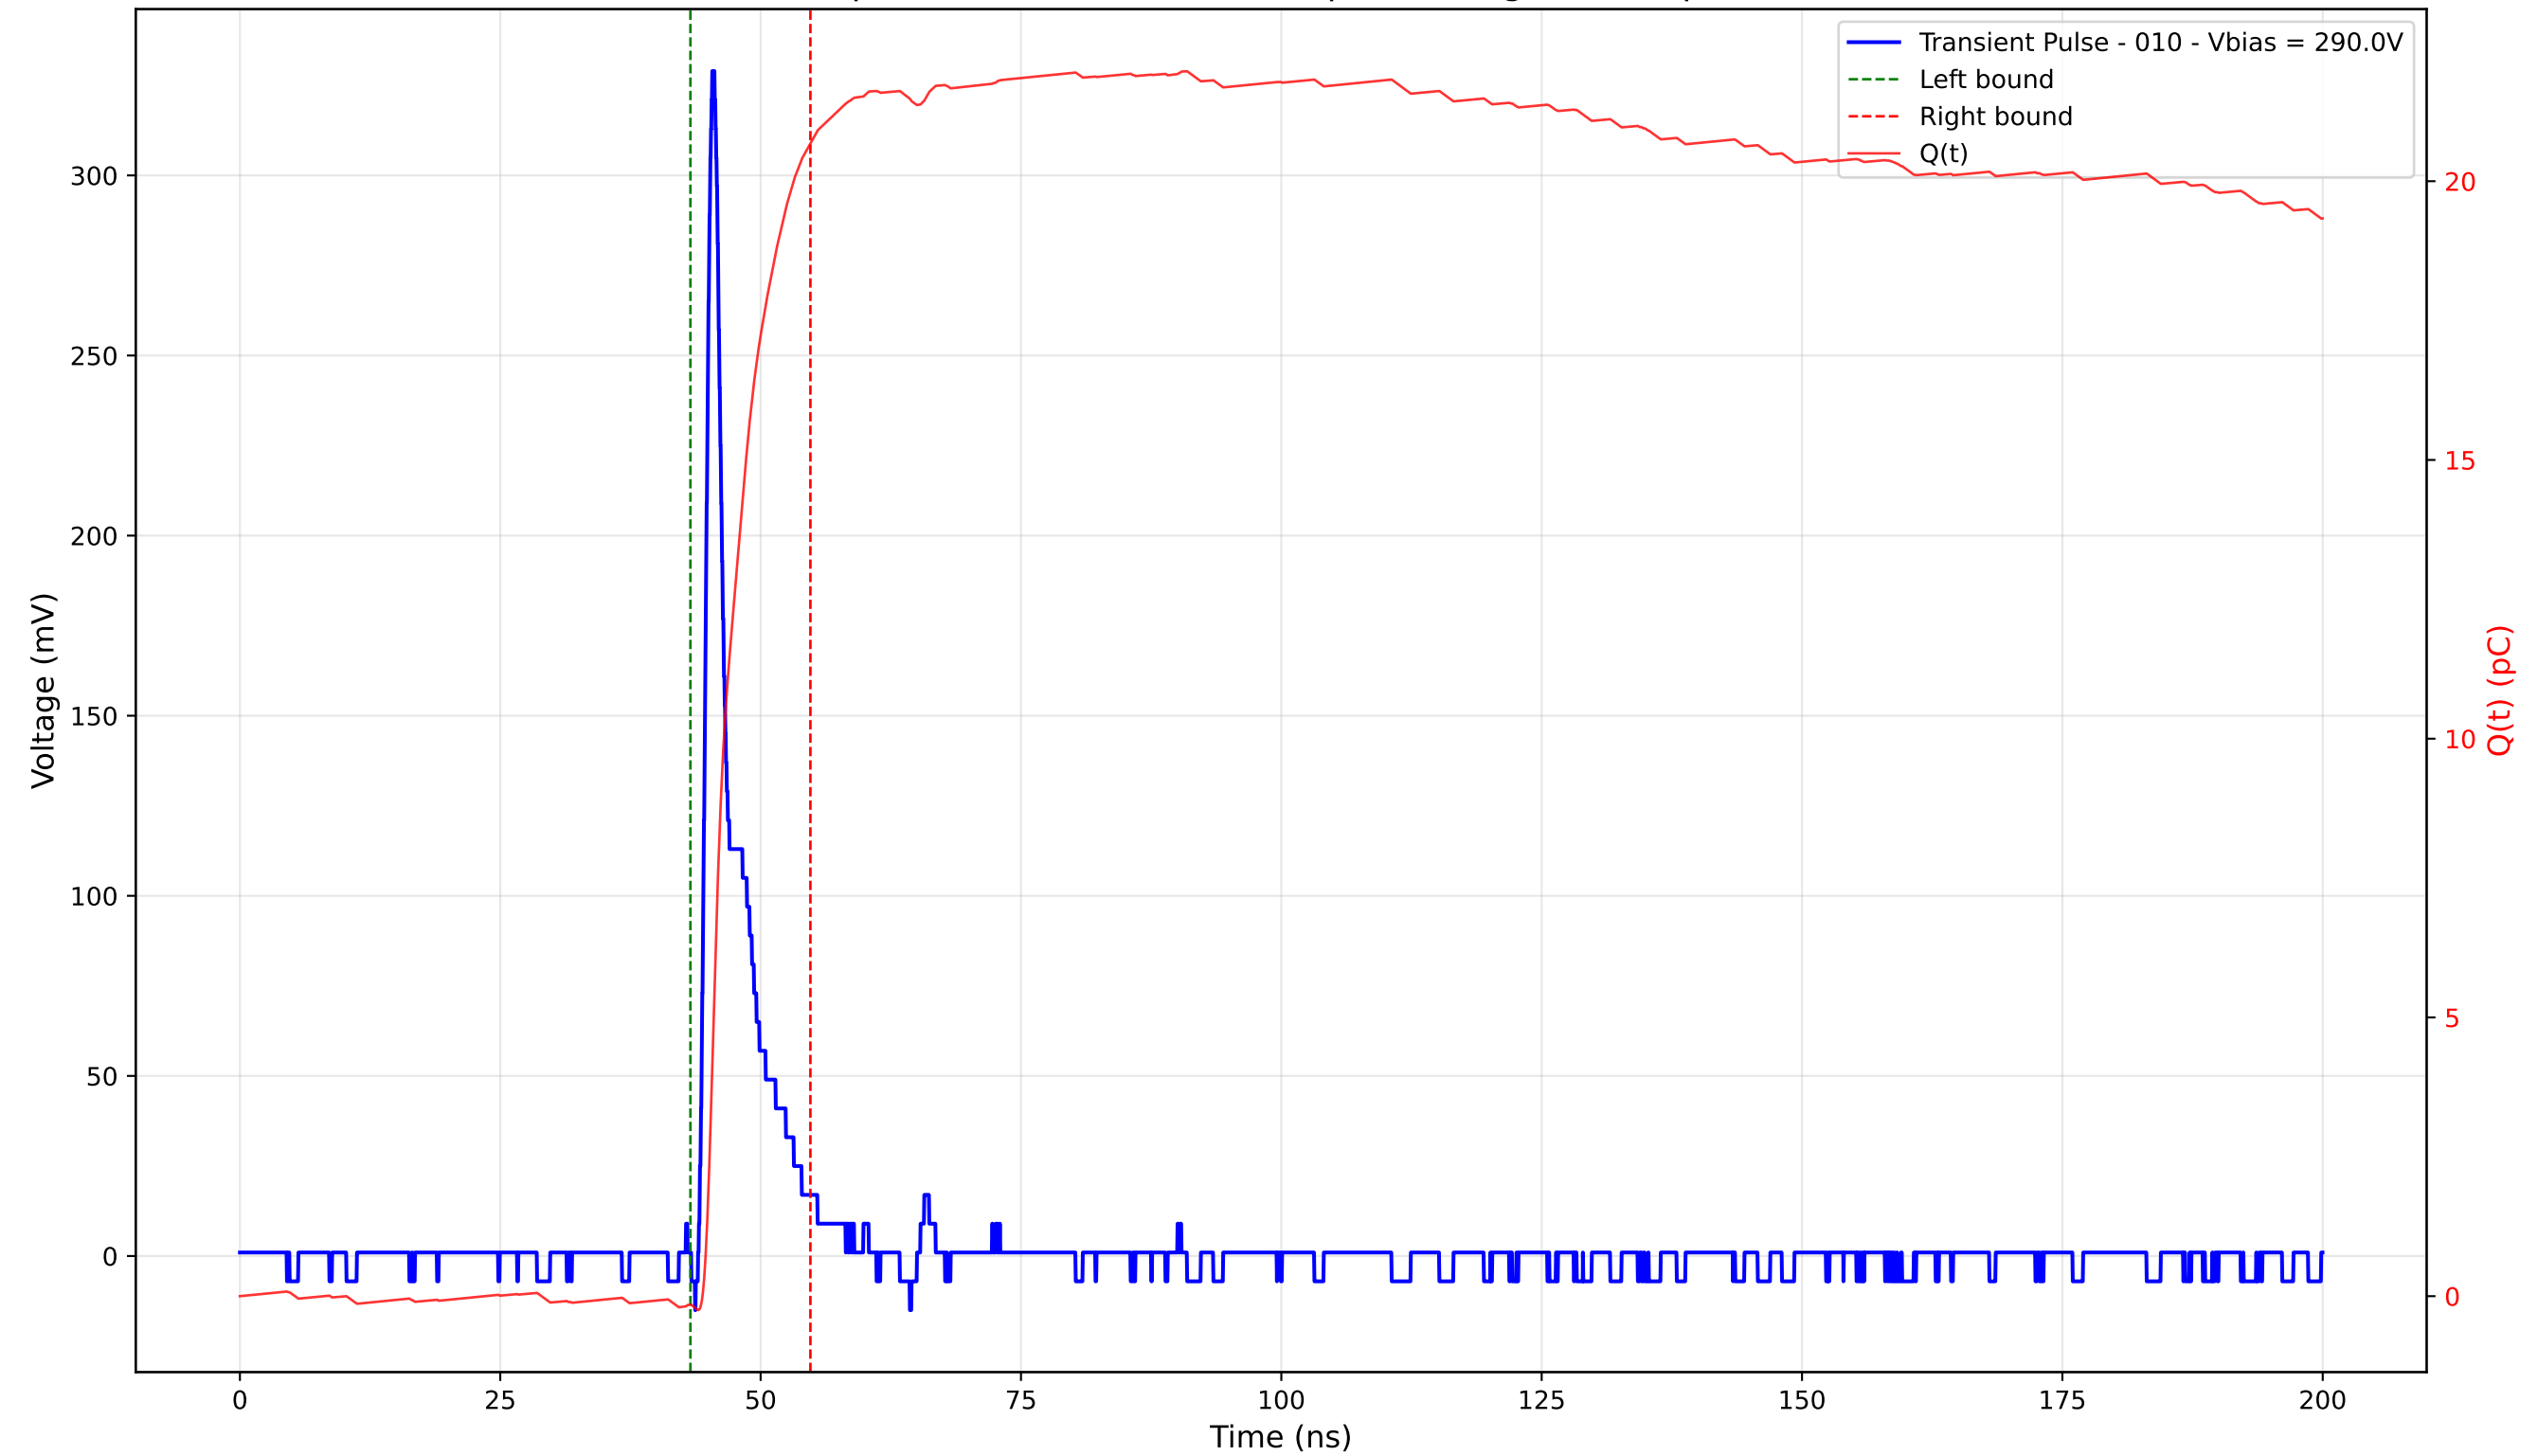


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 26.16 pC - Rise Time: 0.90 ns

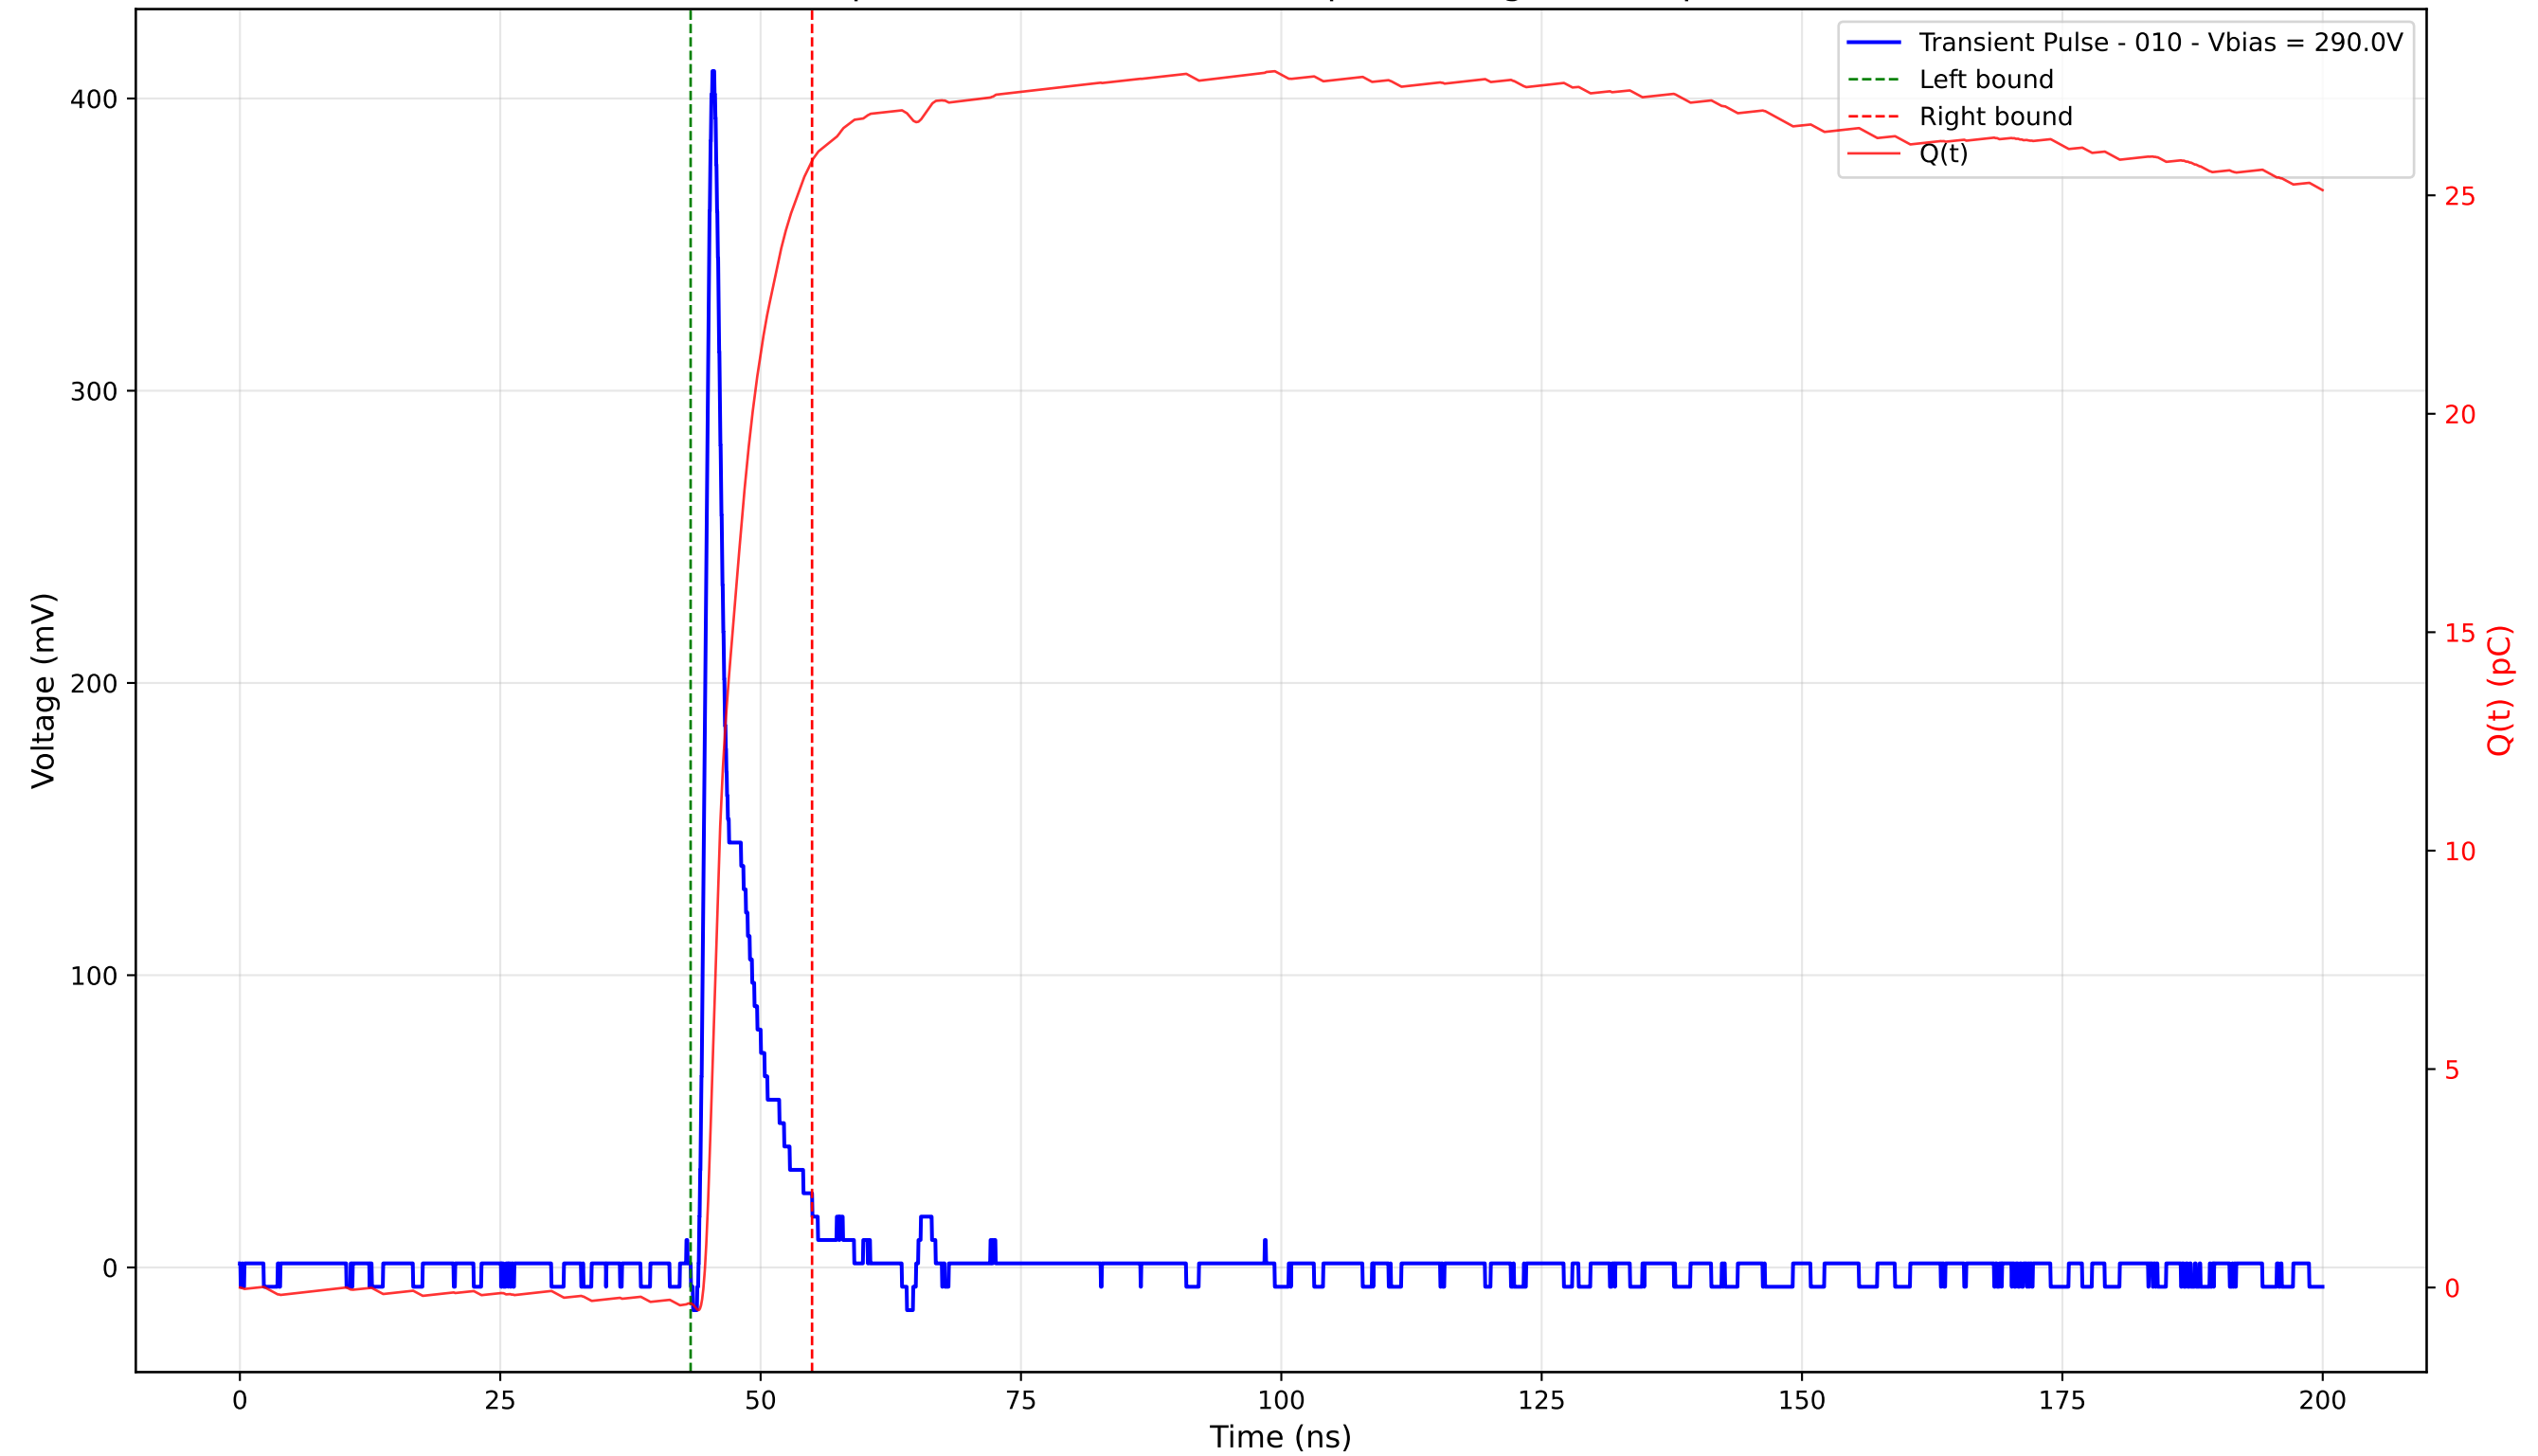


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 31.57 pC - Rise Time: 0.90 ns

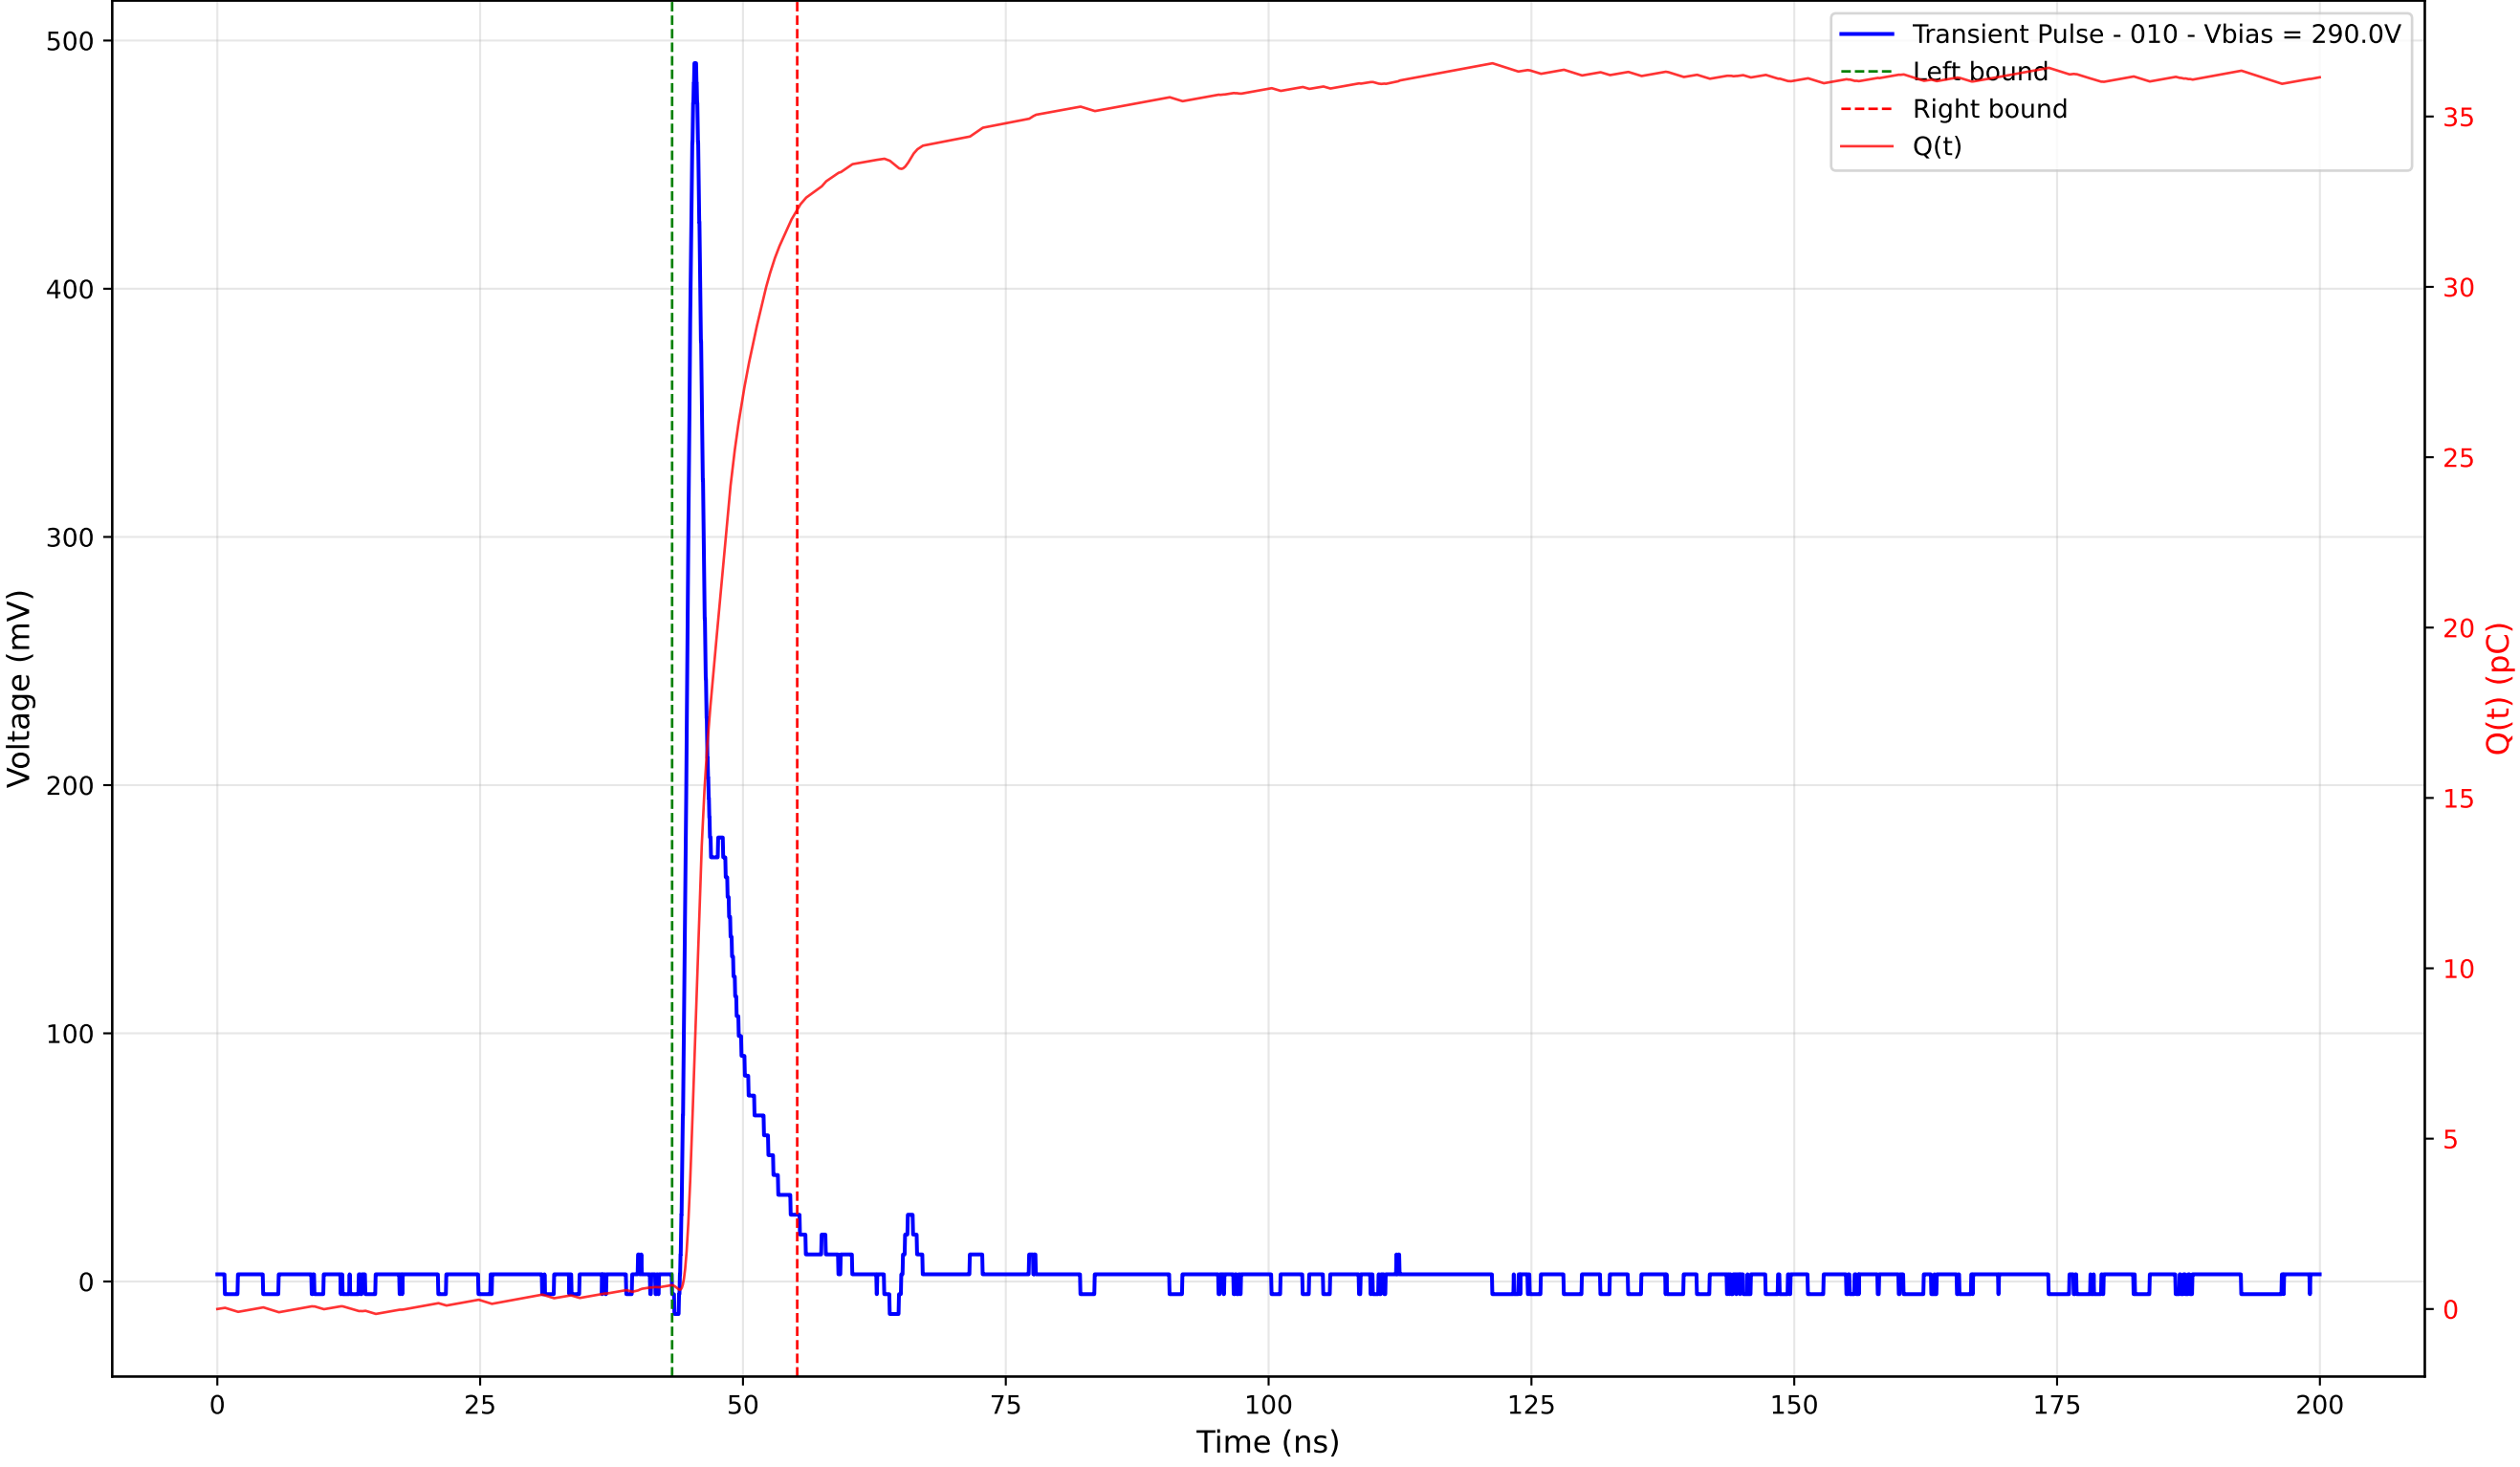


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 34.05 pC - Rise Time: 0.88 ns

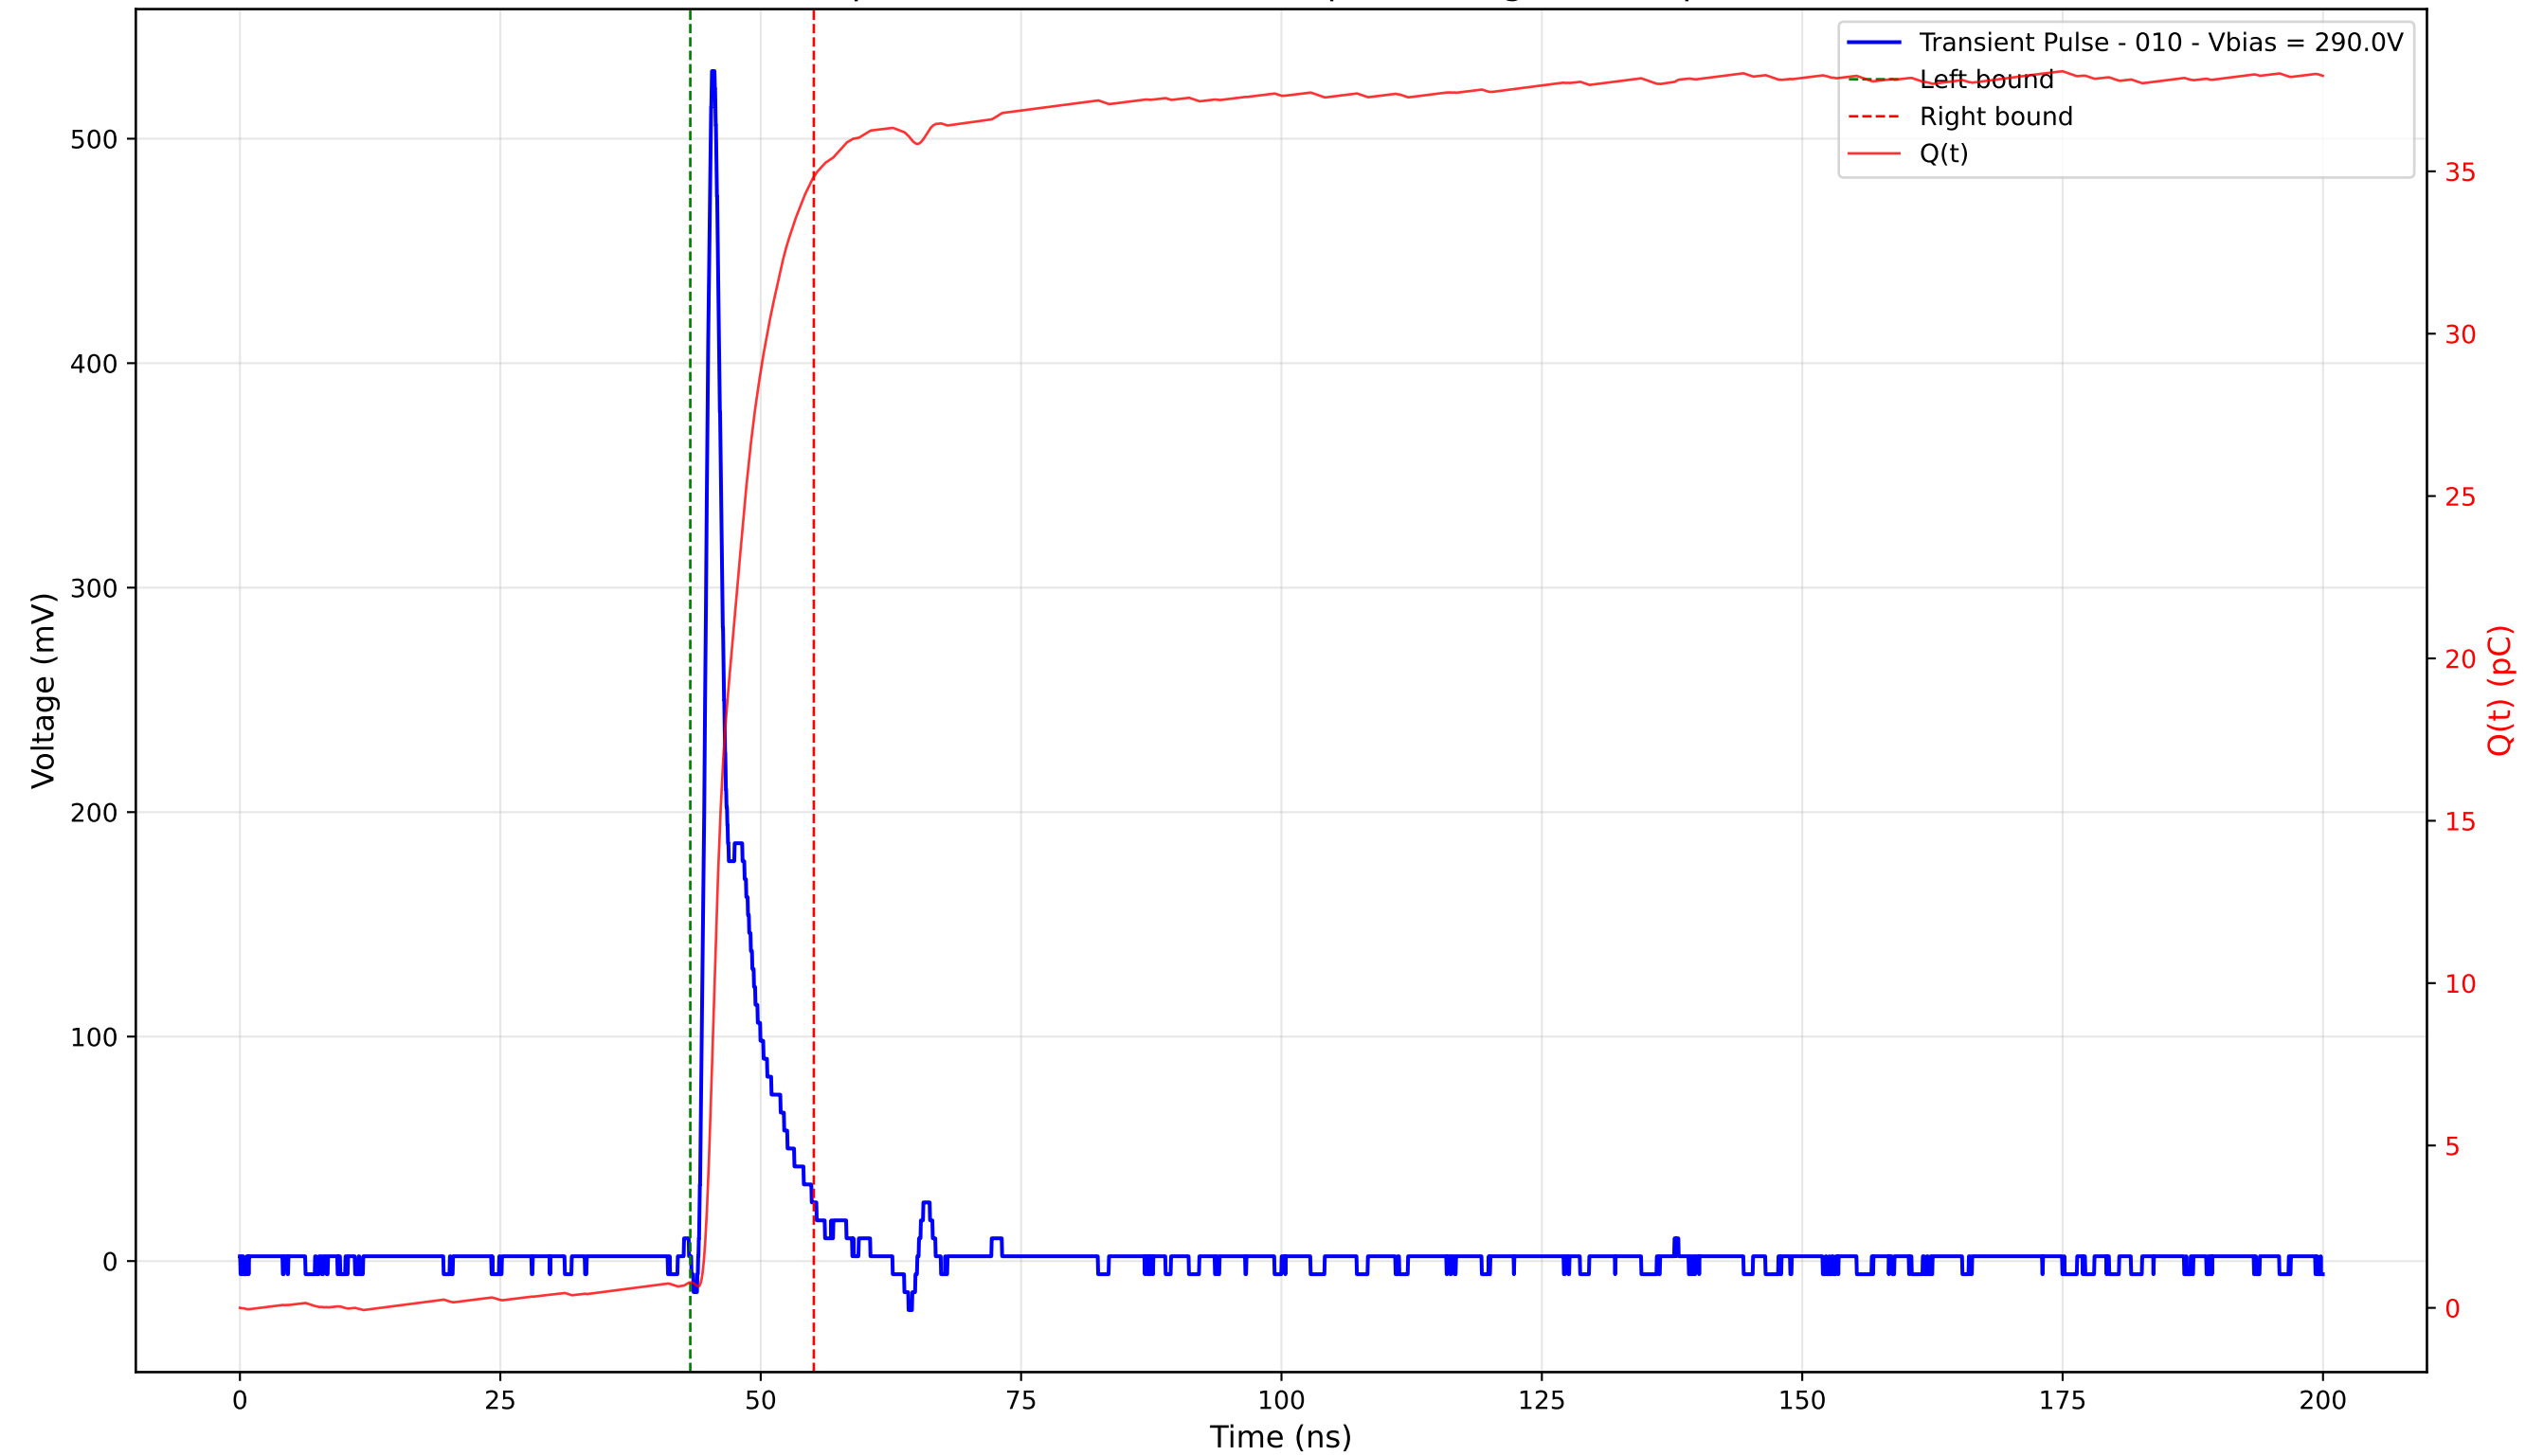


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 35.70 pC - Rise Time: 0.90 ns

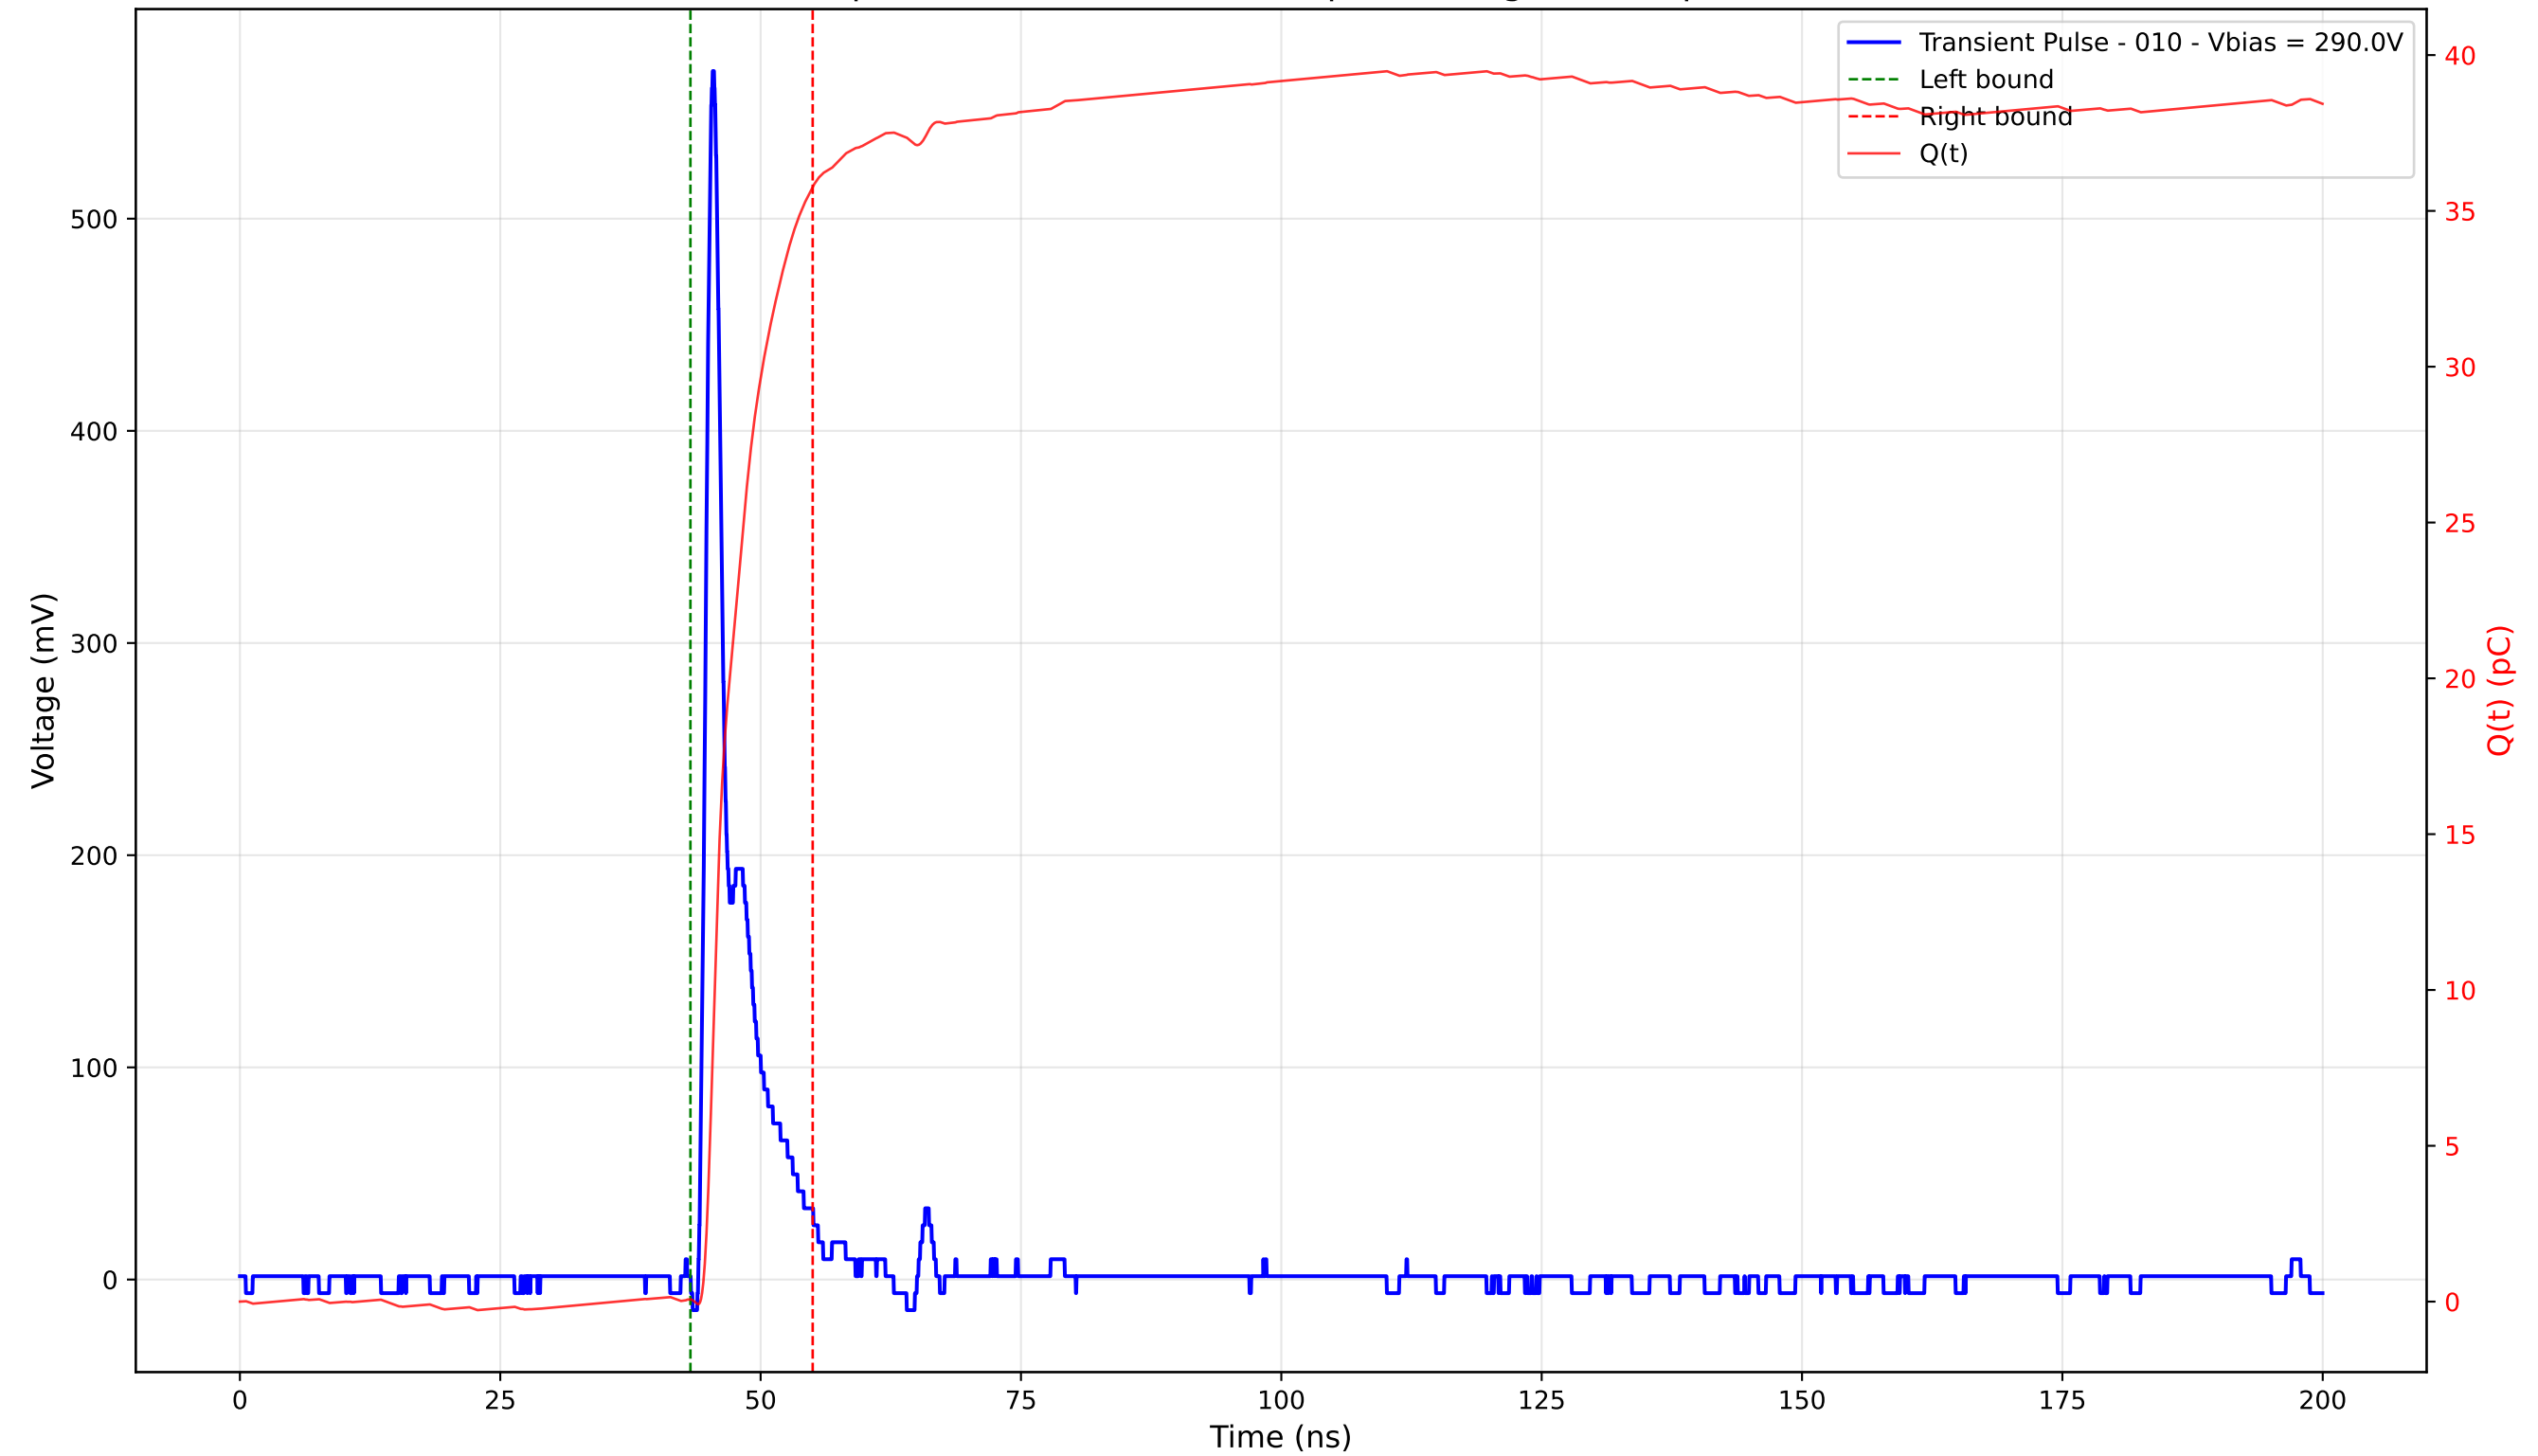


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 36.29 pC - Rise Time: 0.91 ns

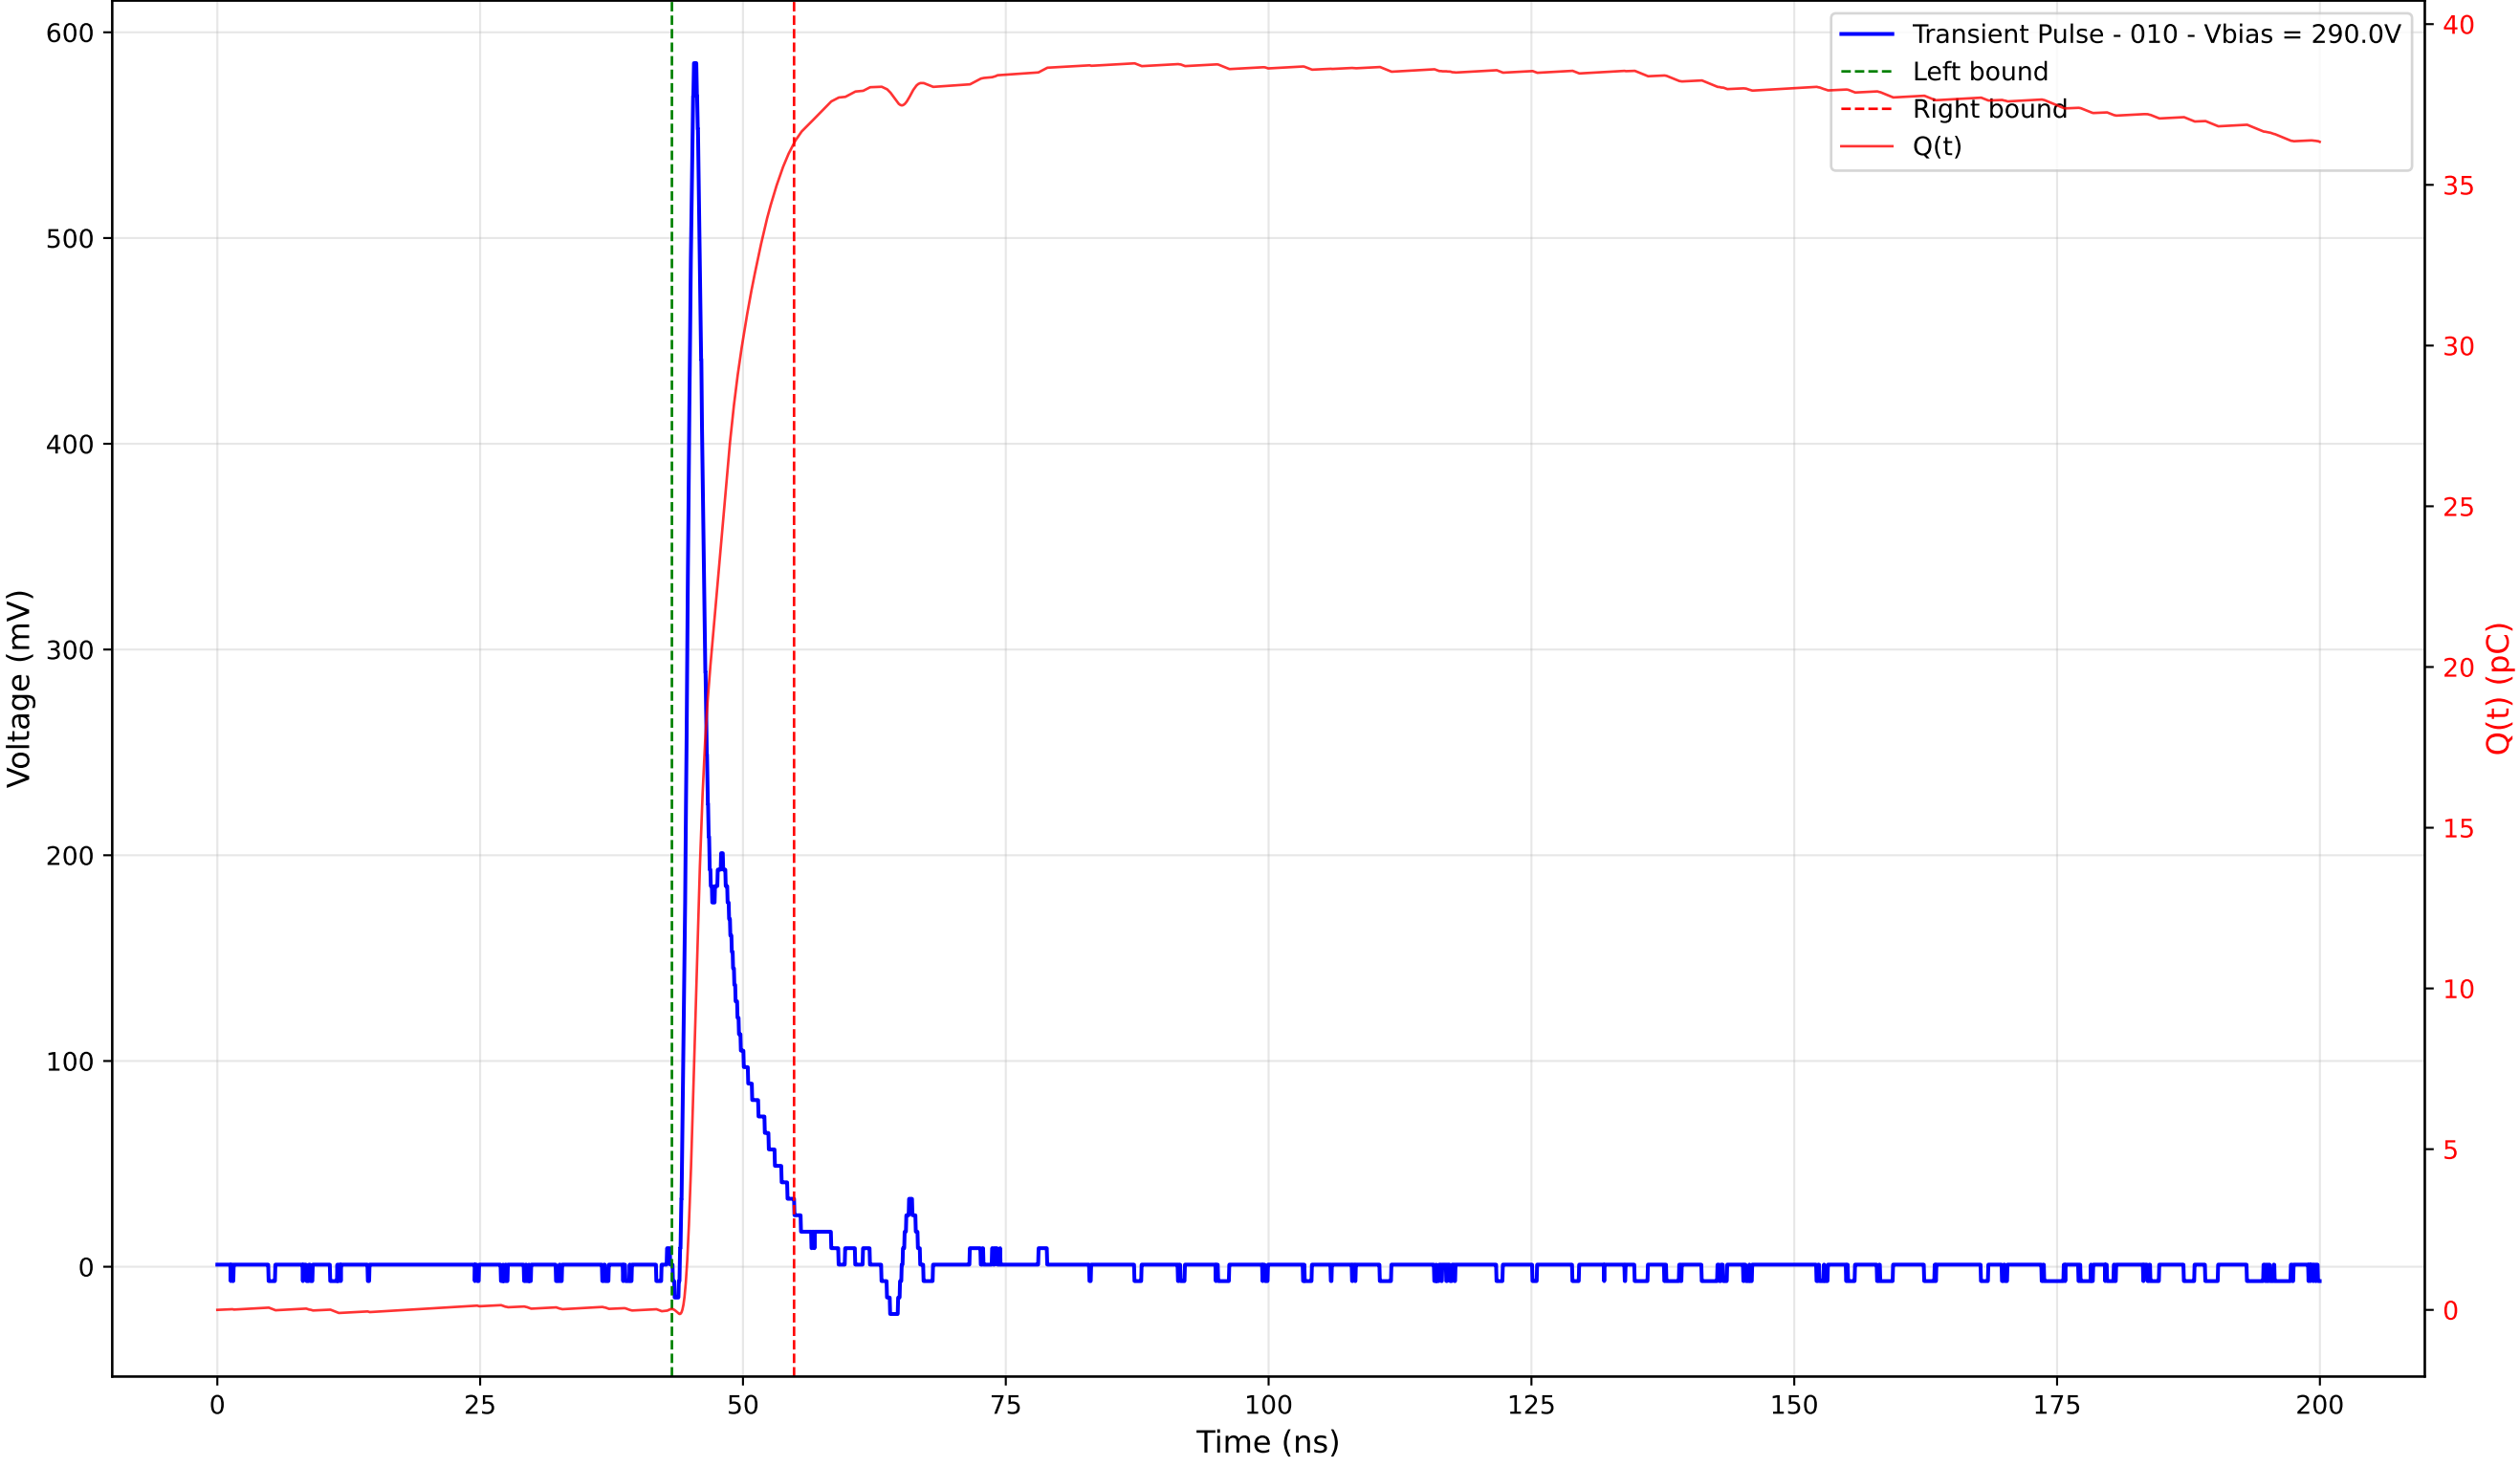


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 36.57 pC - Rise Time: 0.88 ns

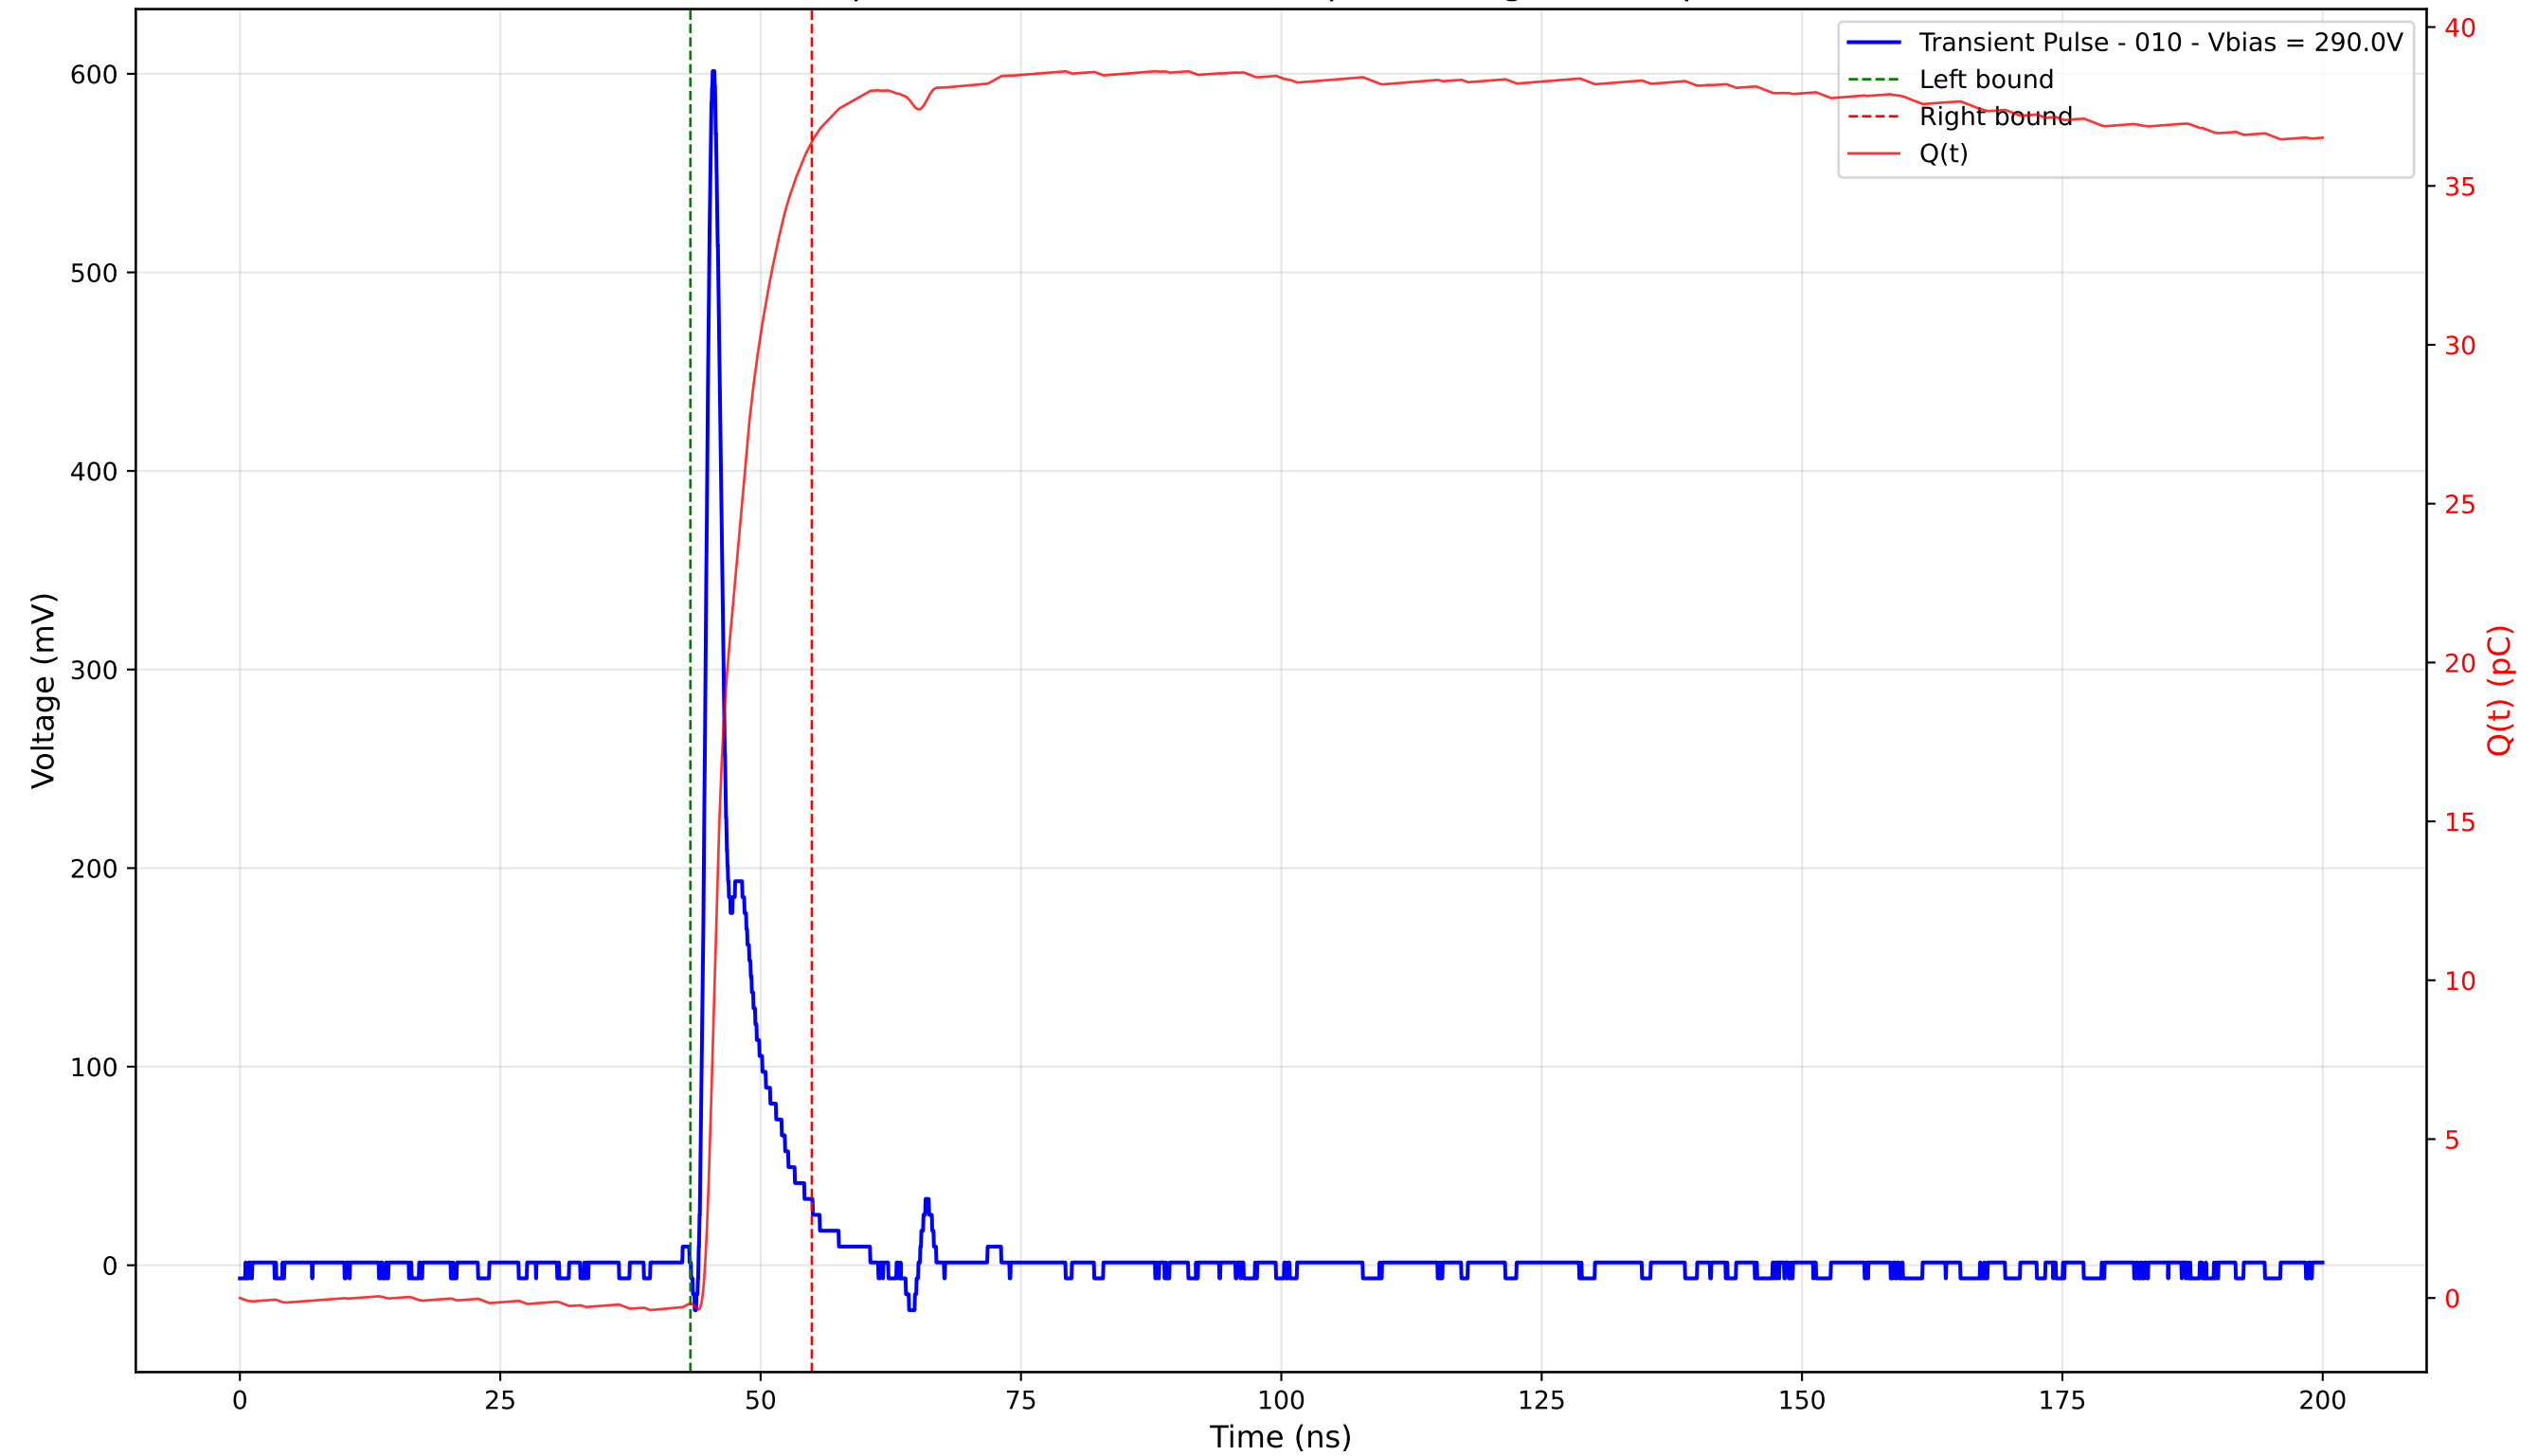


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 36.58 pC - Rise Time: 0.88 ns

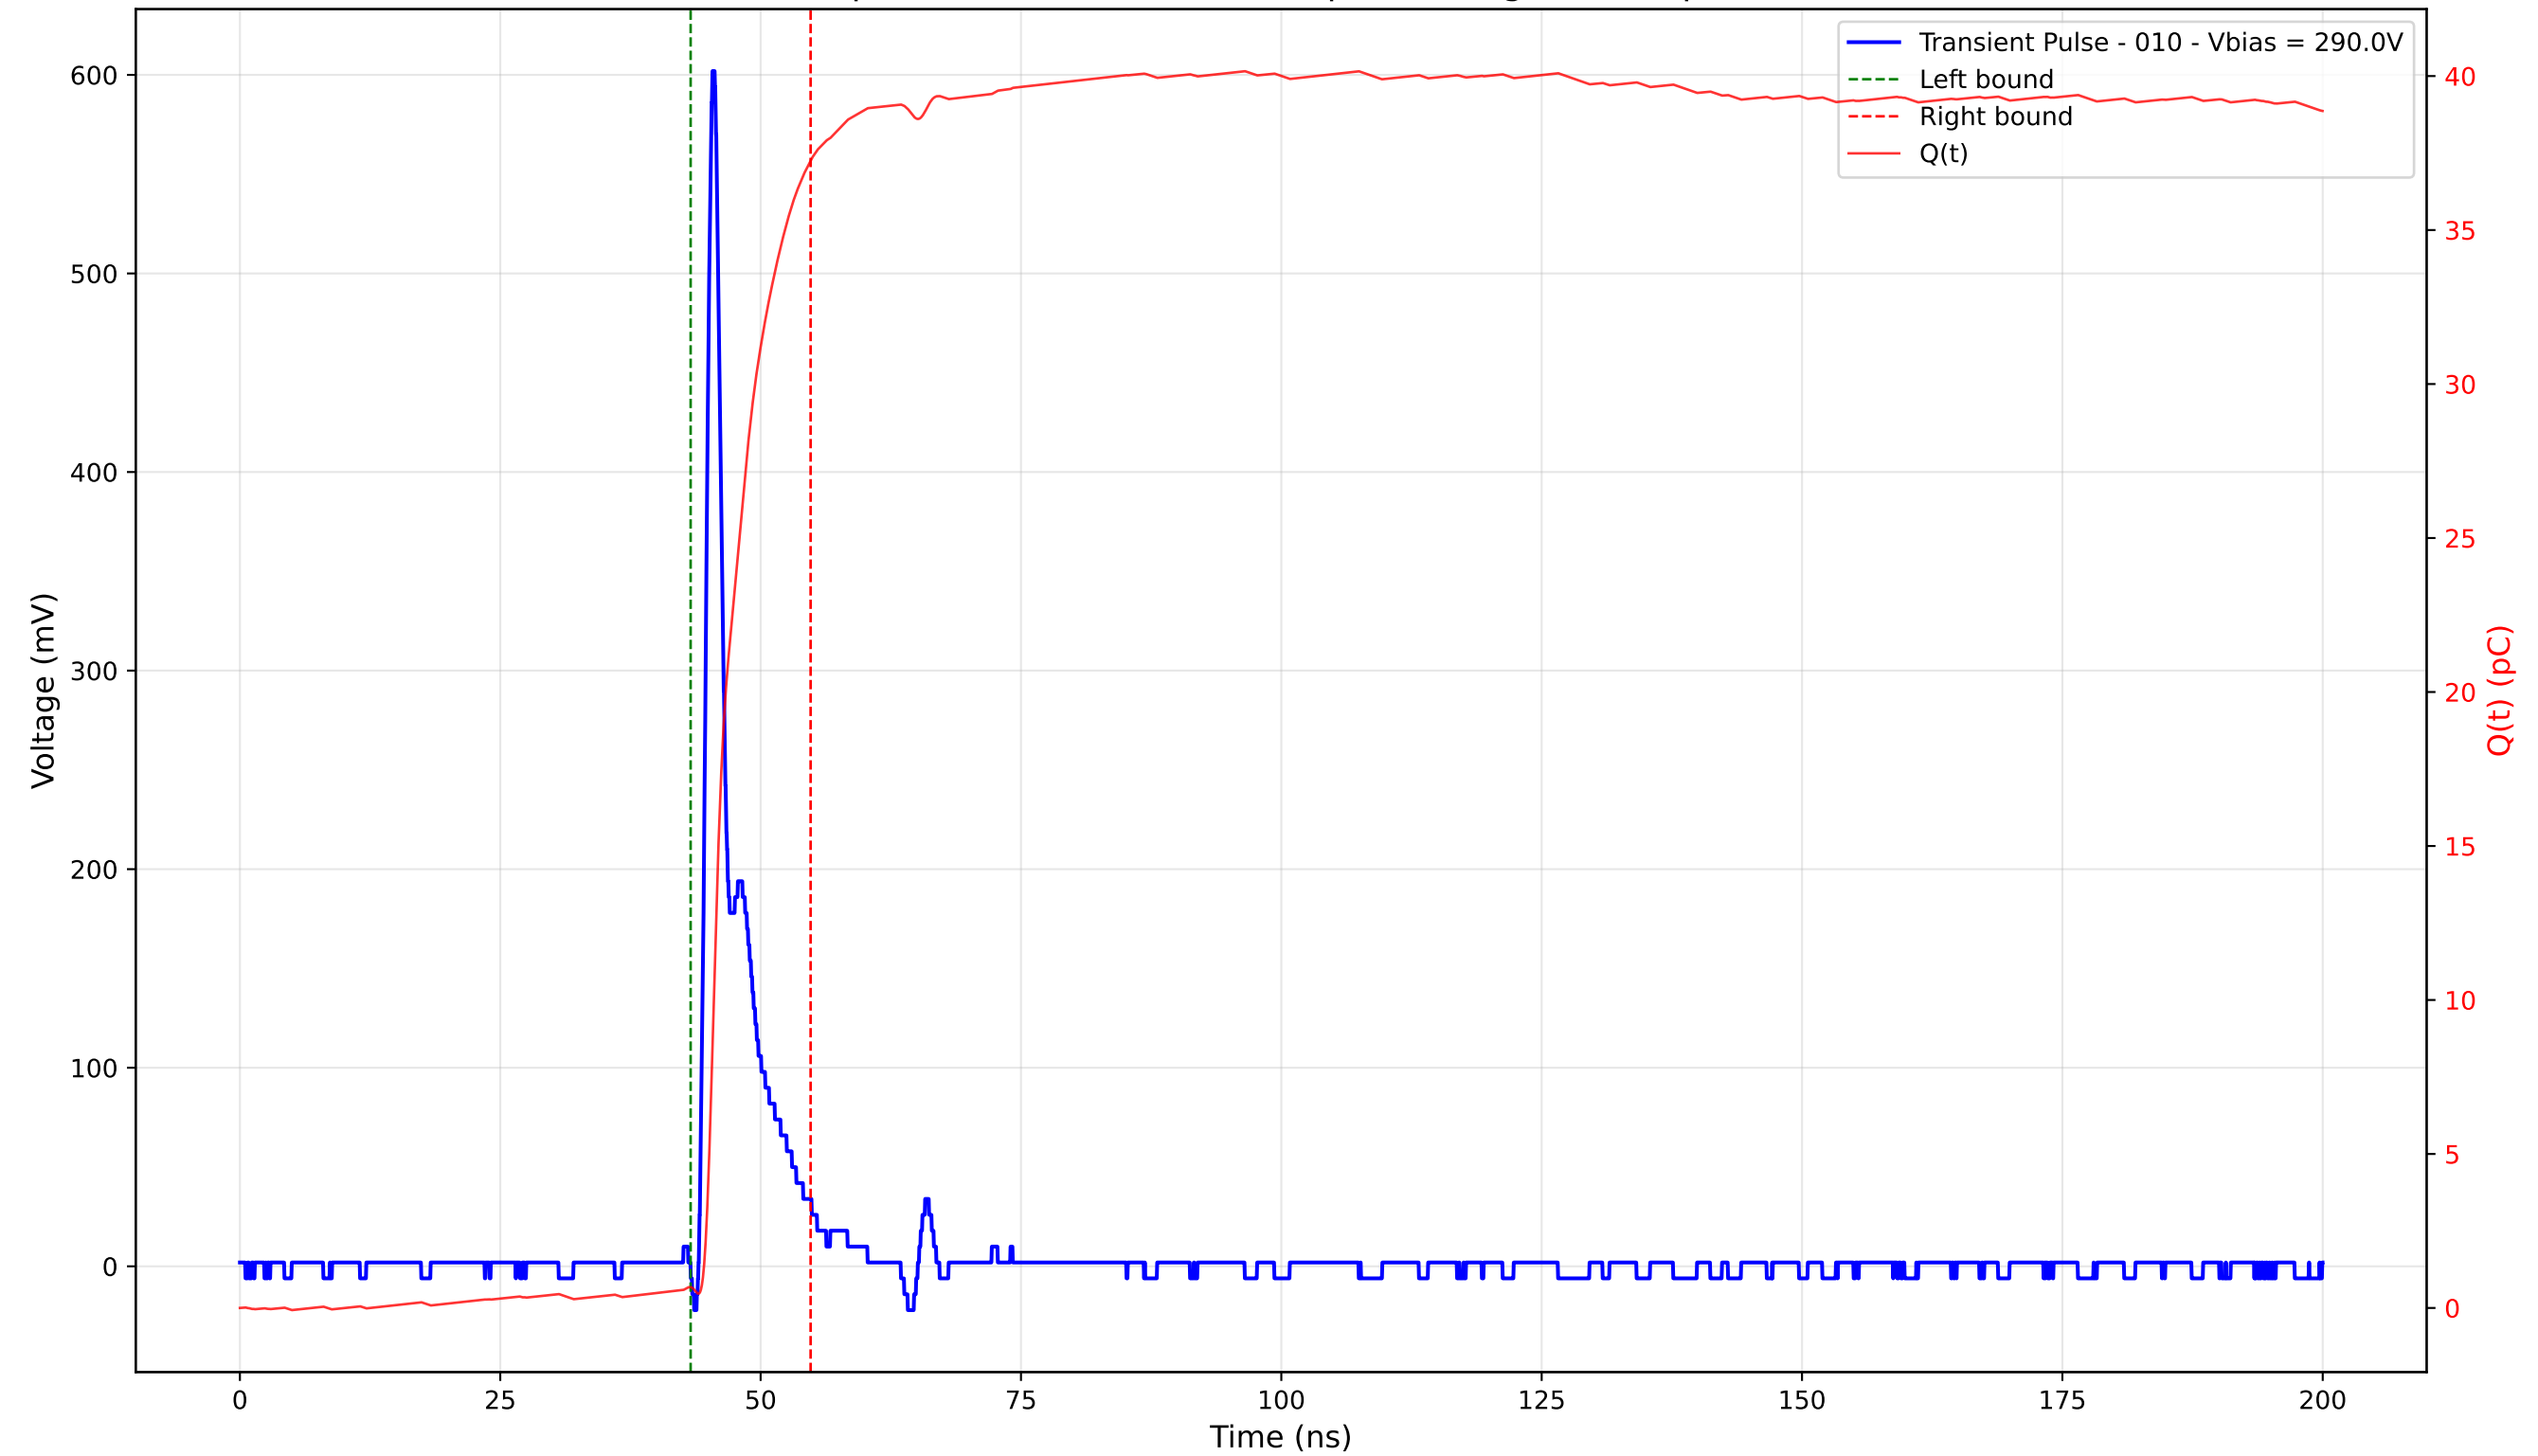


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 36.14 pC - Rise Time: 0.92 ns

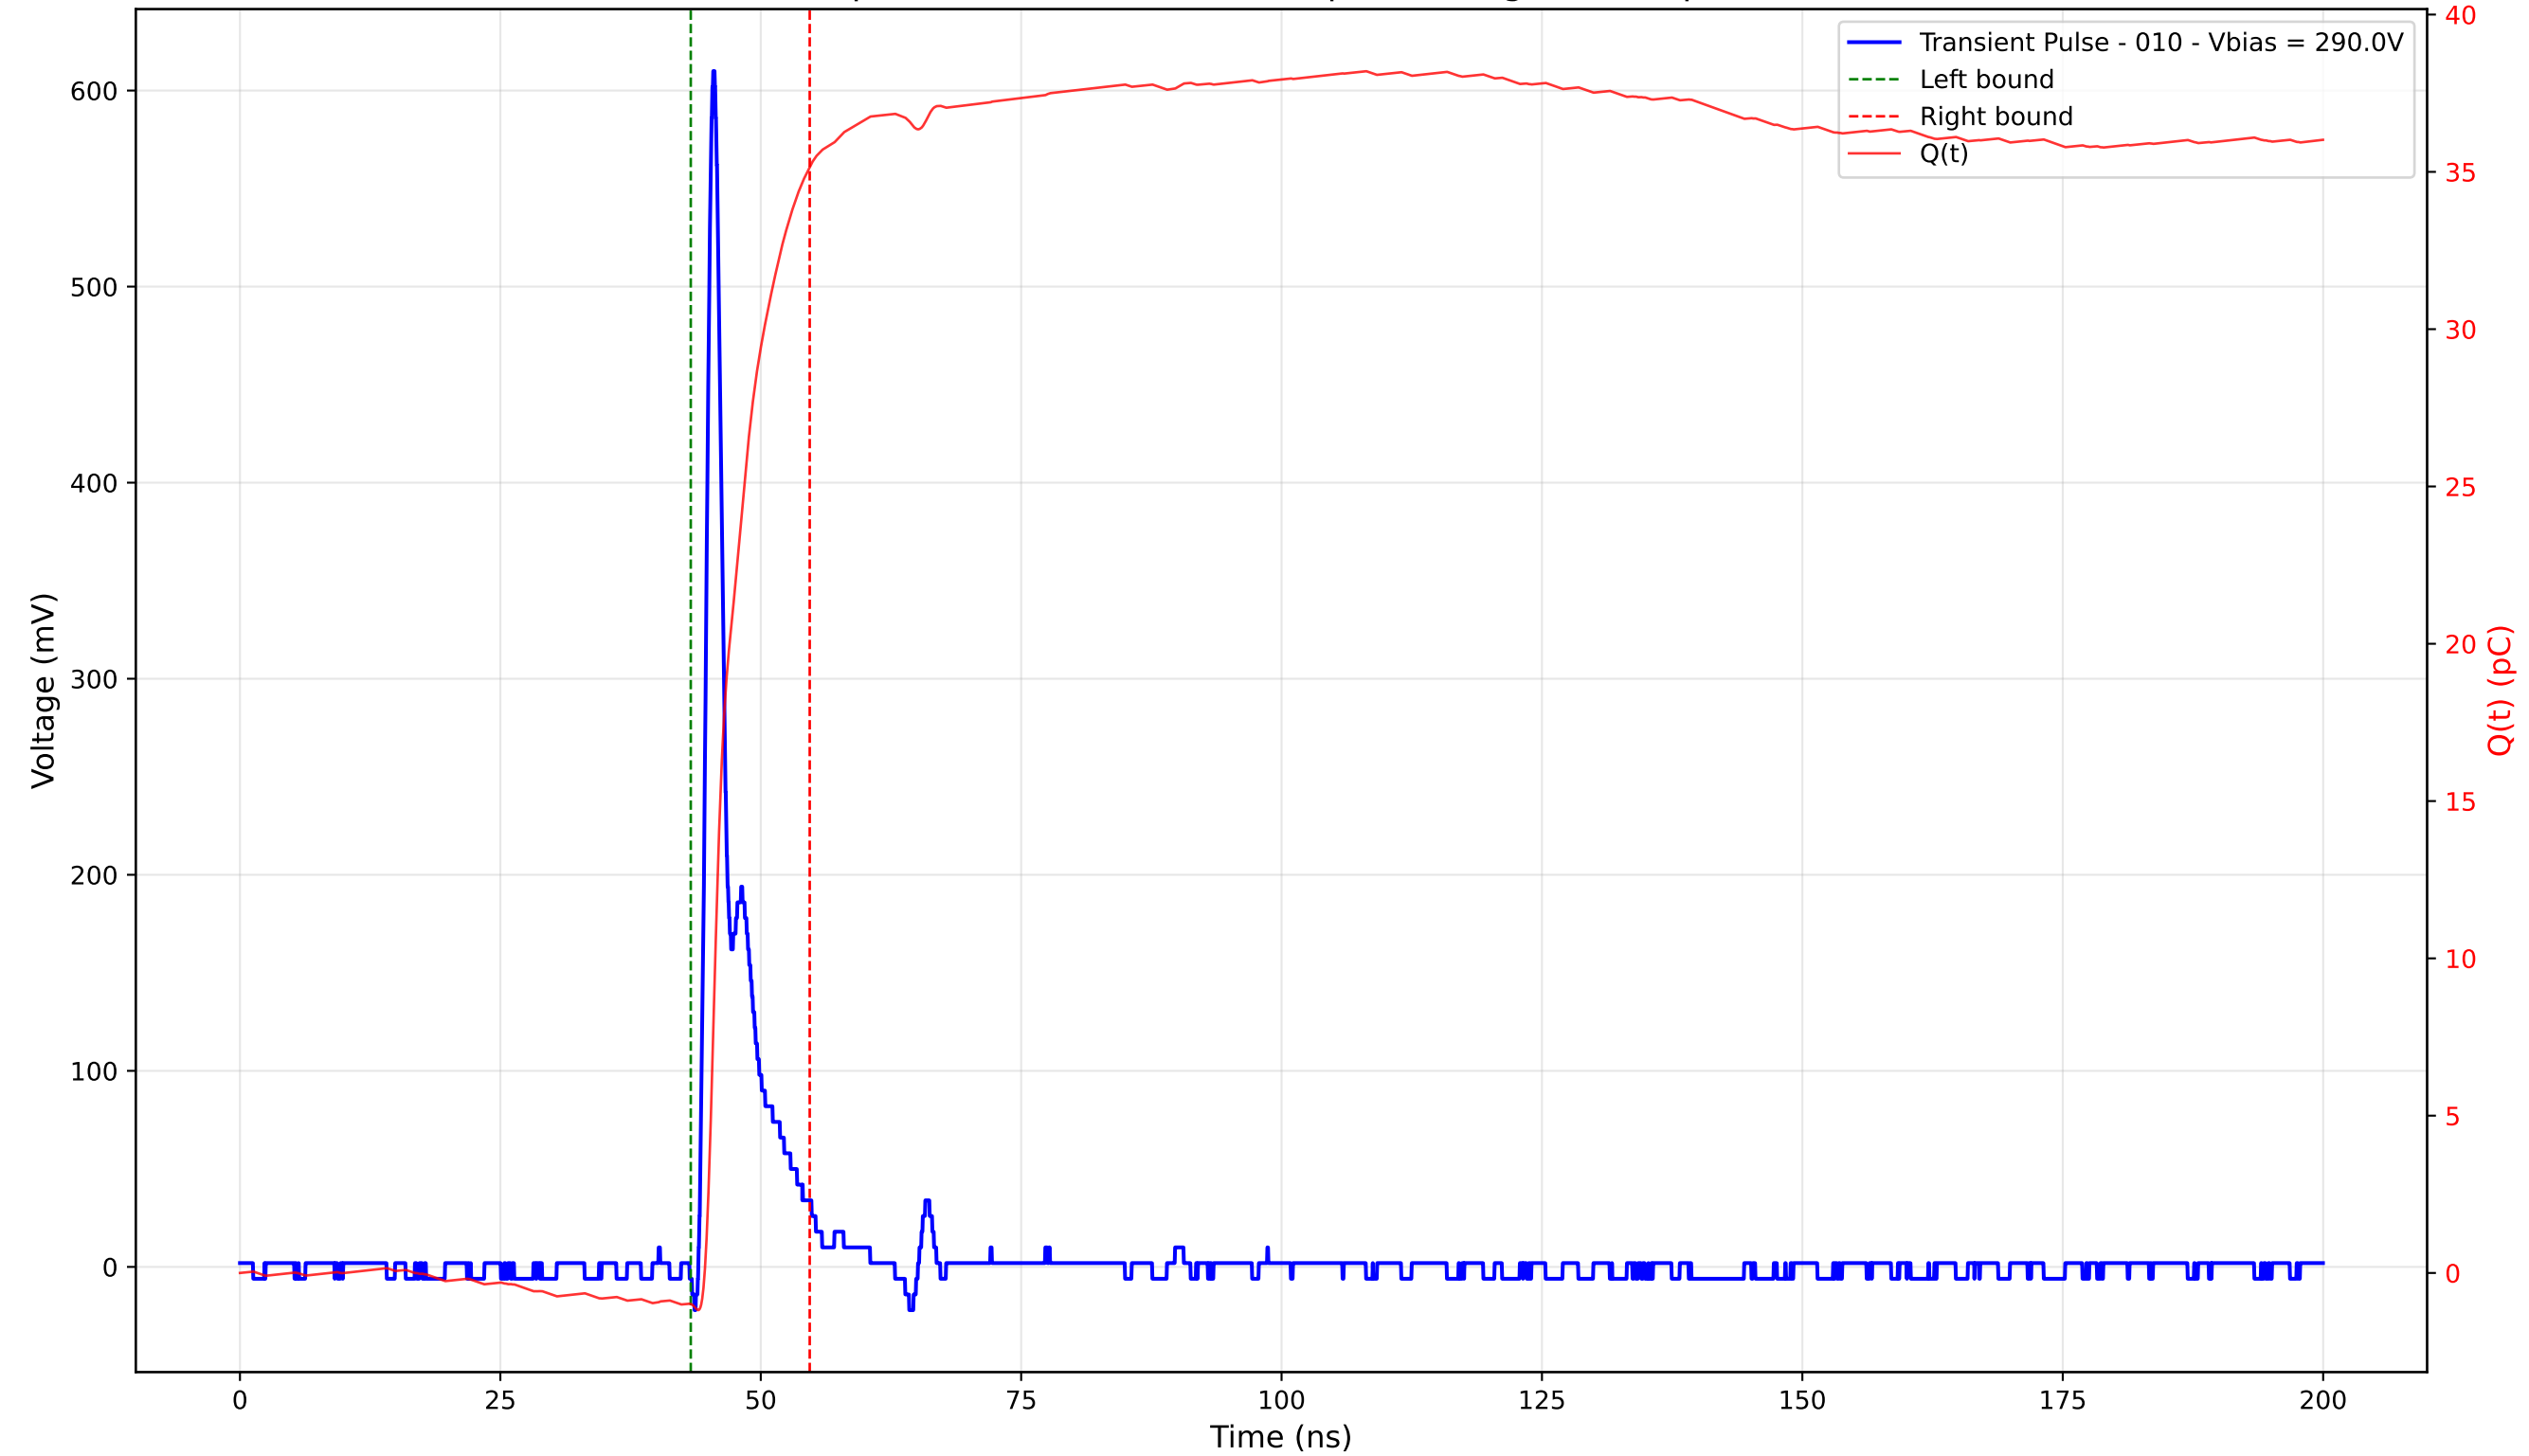


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 36.07 pC - Rise Time: 0.91 ns

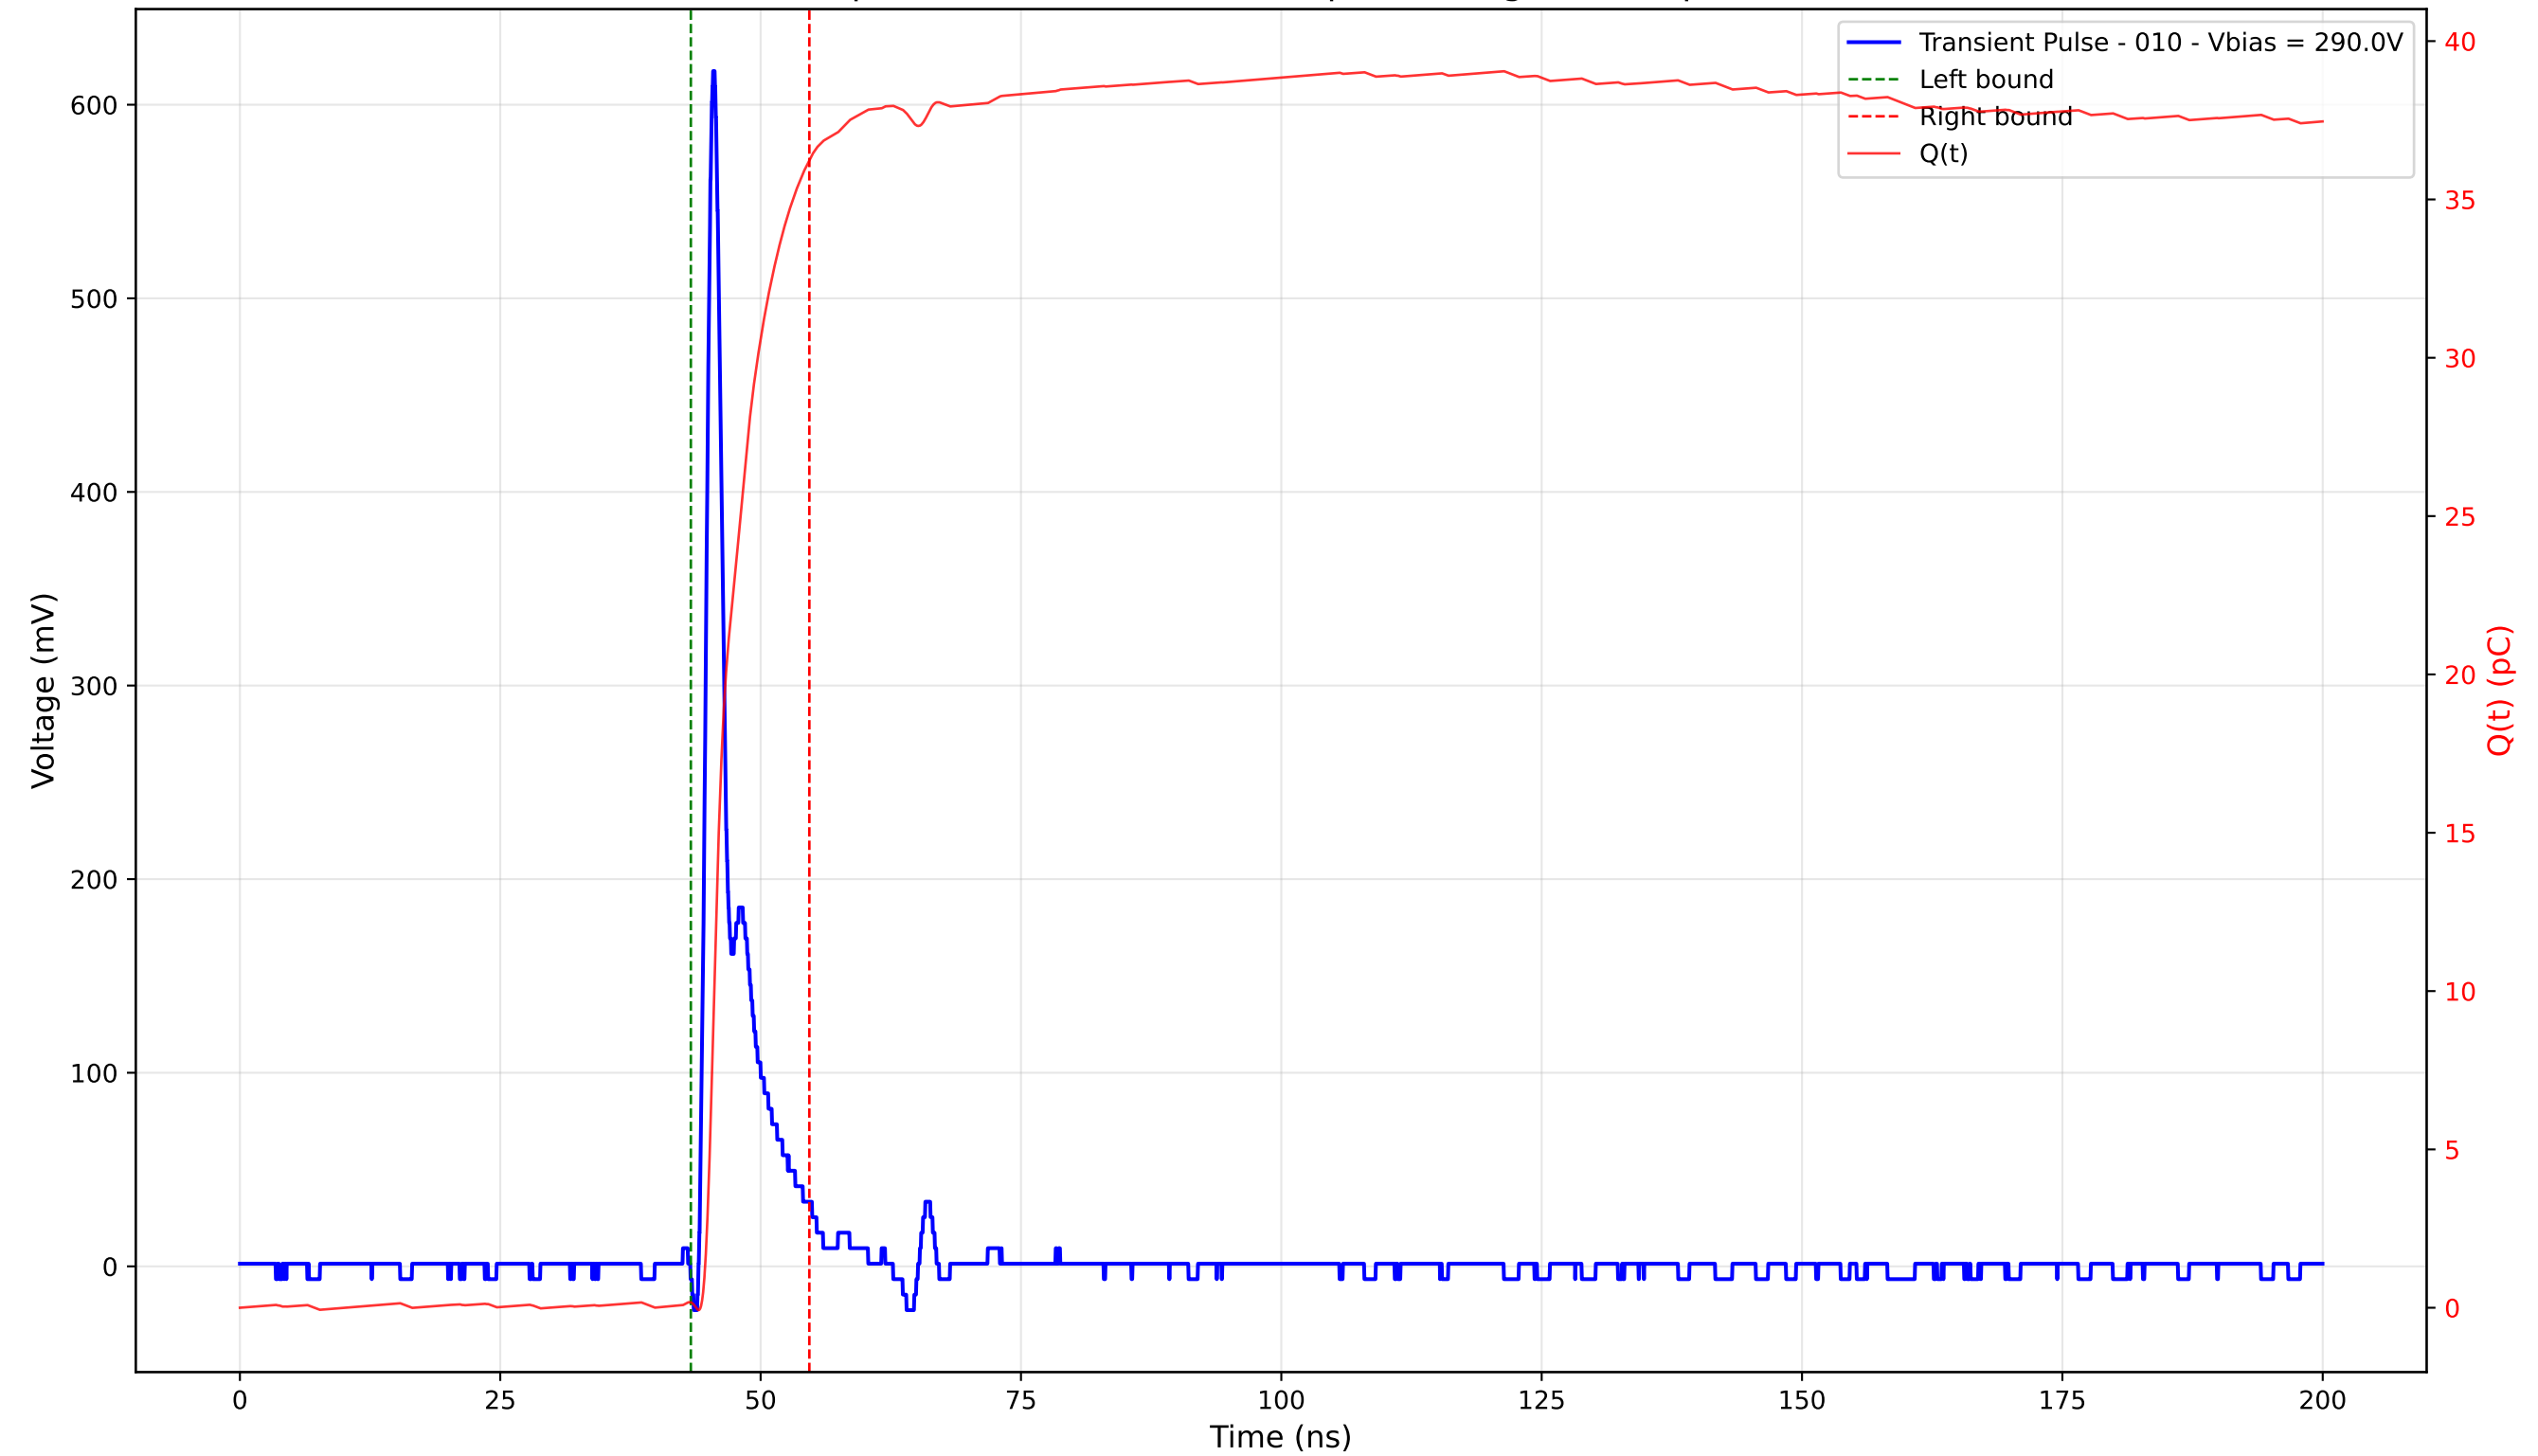


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 36.05 pC - Rise Time: 0.91 ns

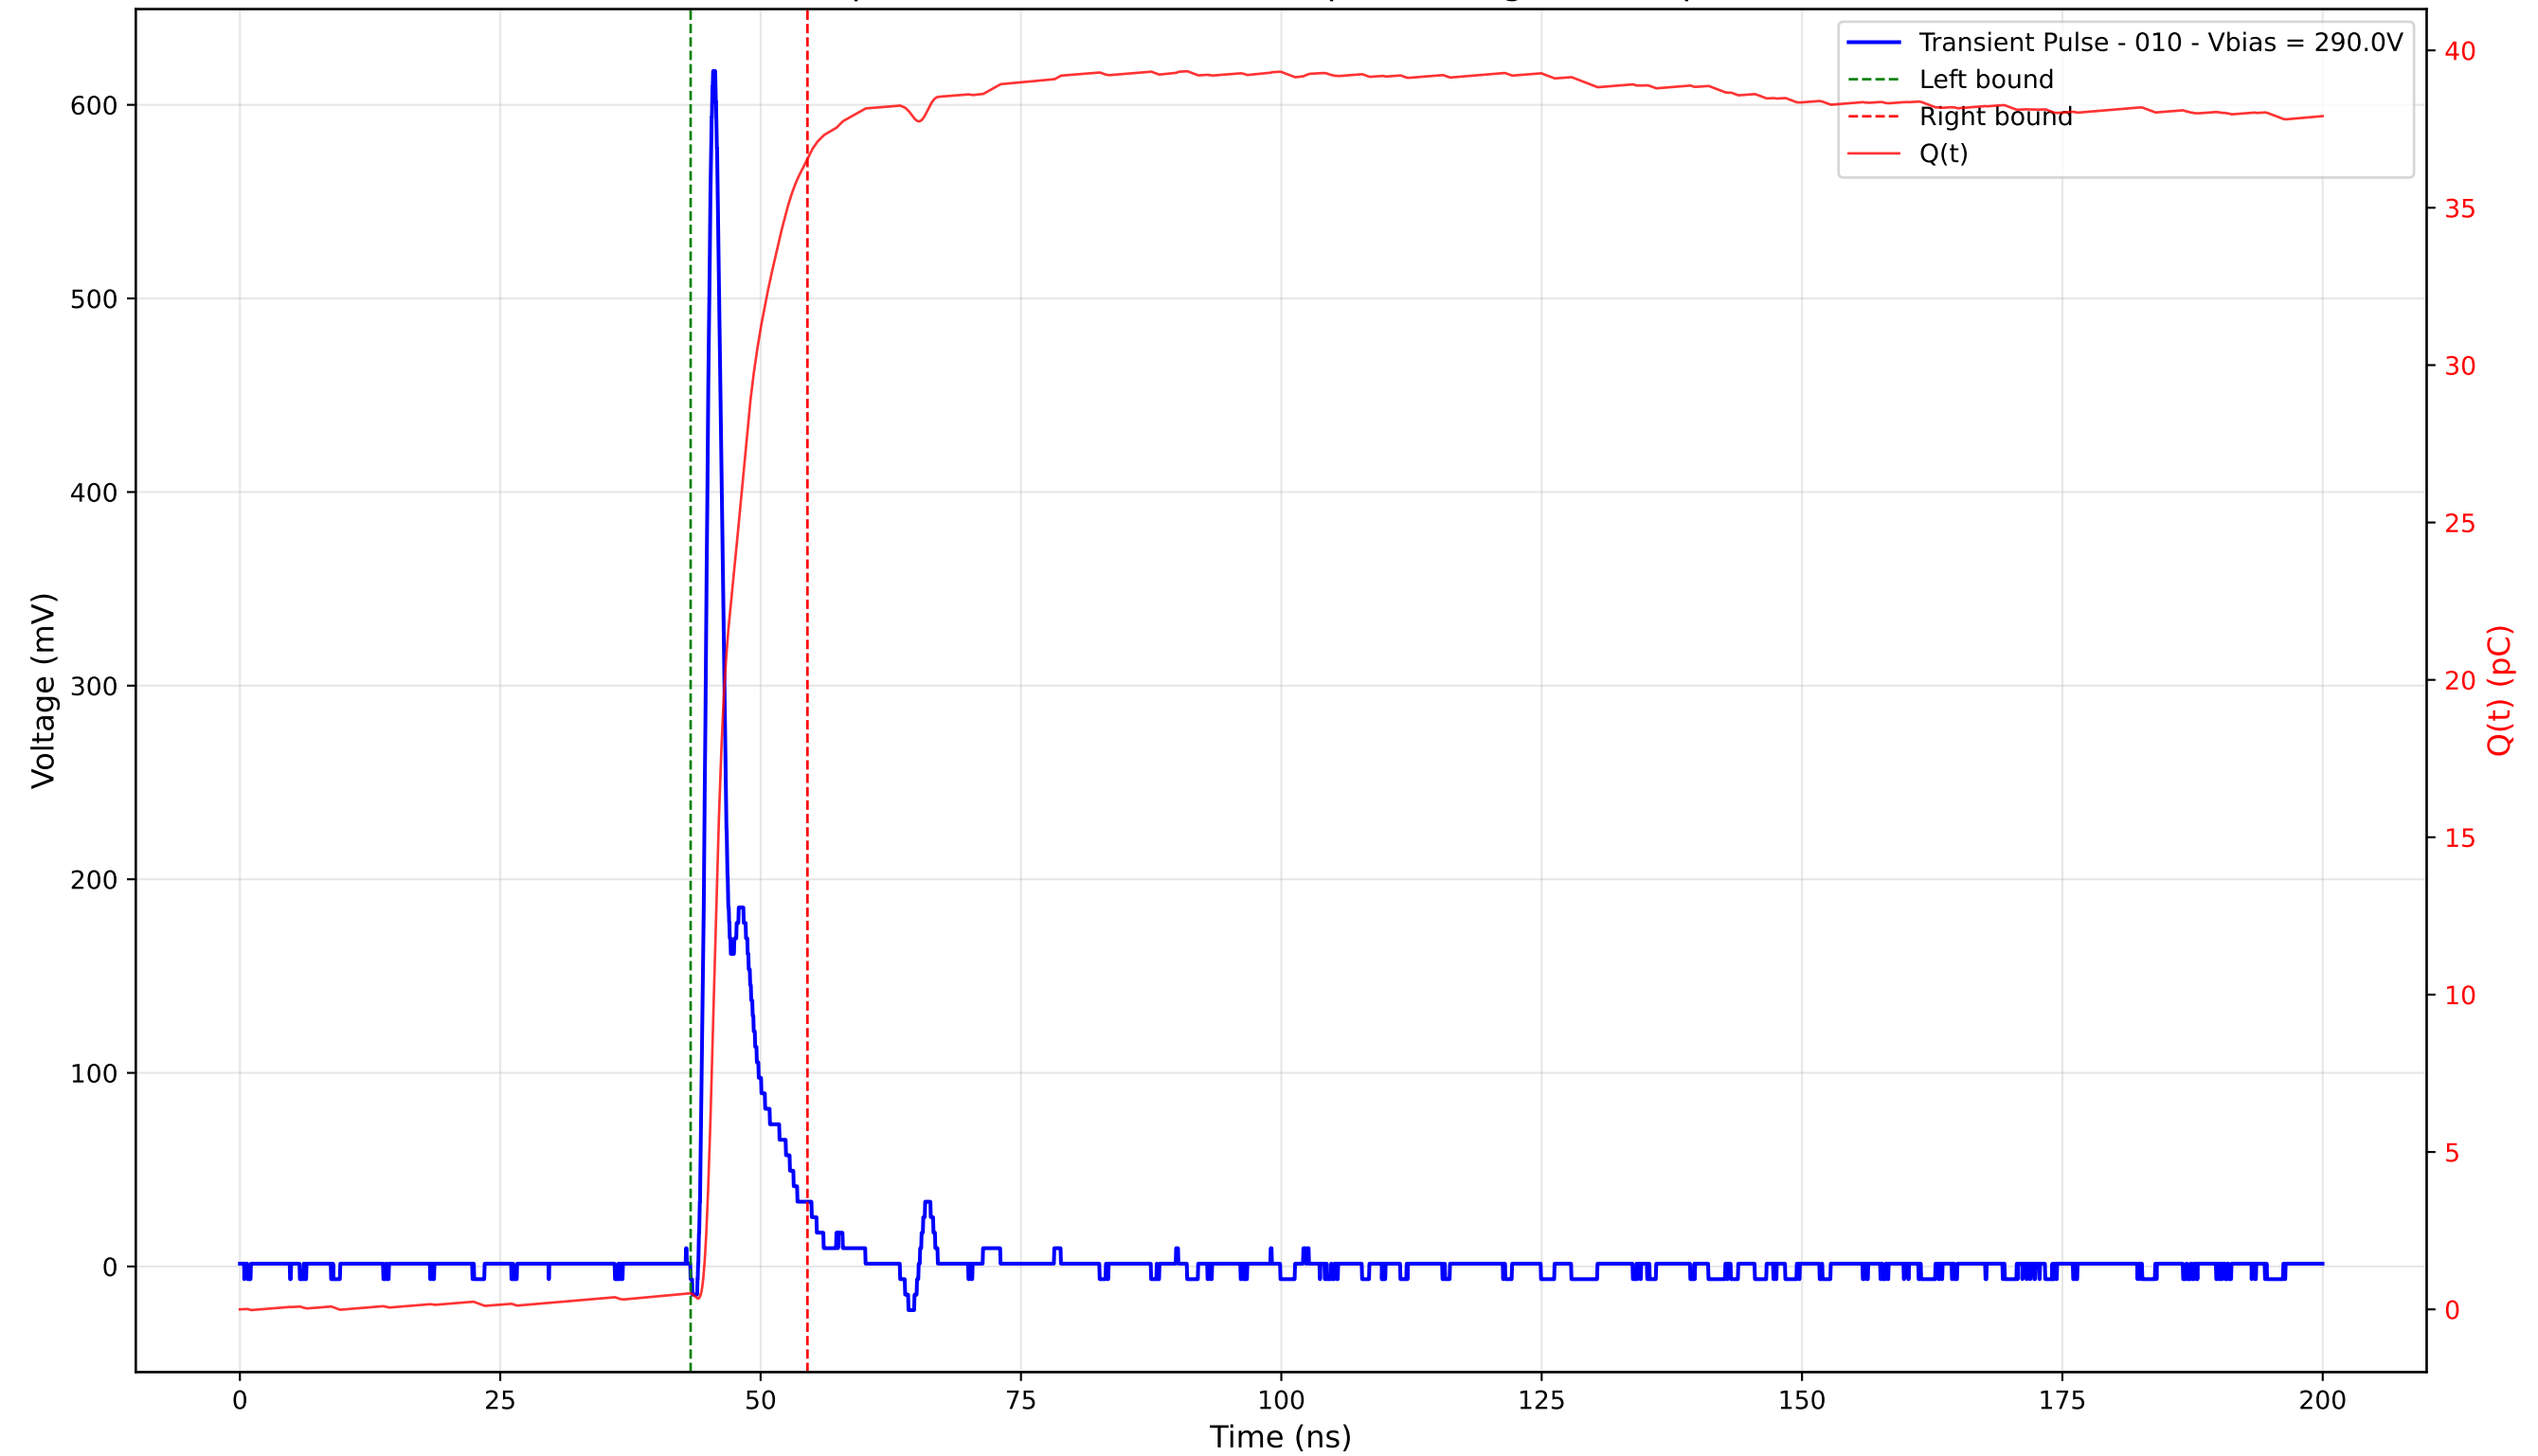


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 36.11 pC - Rise Time: 0.93 ns

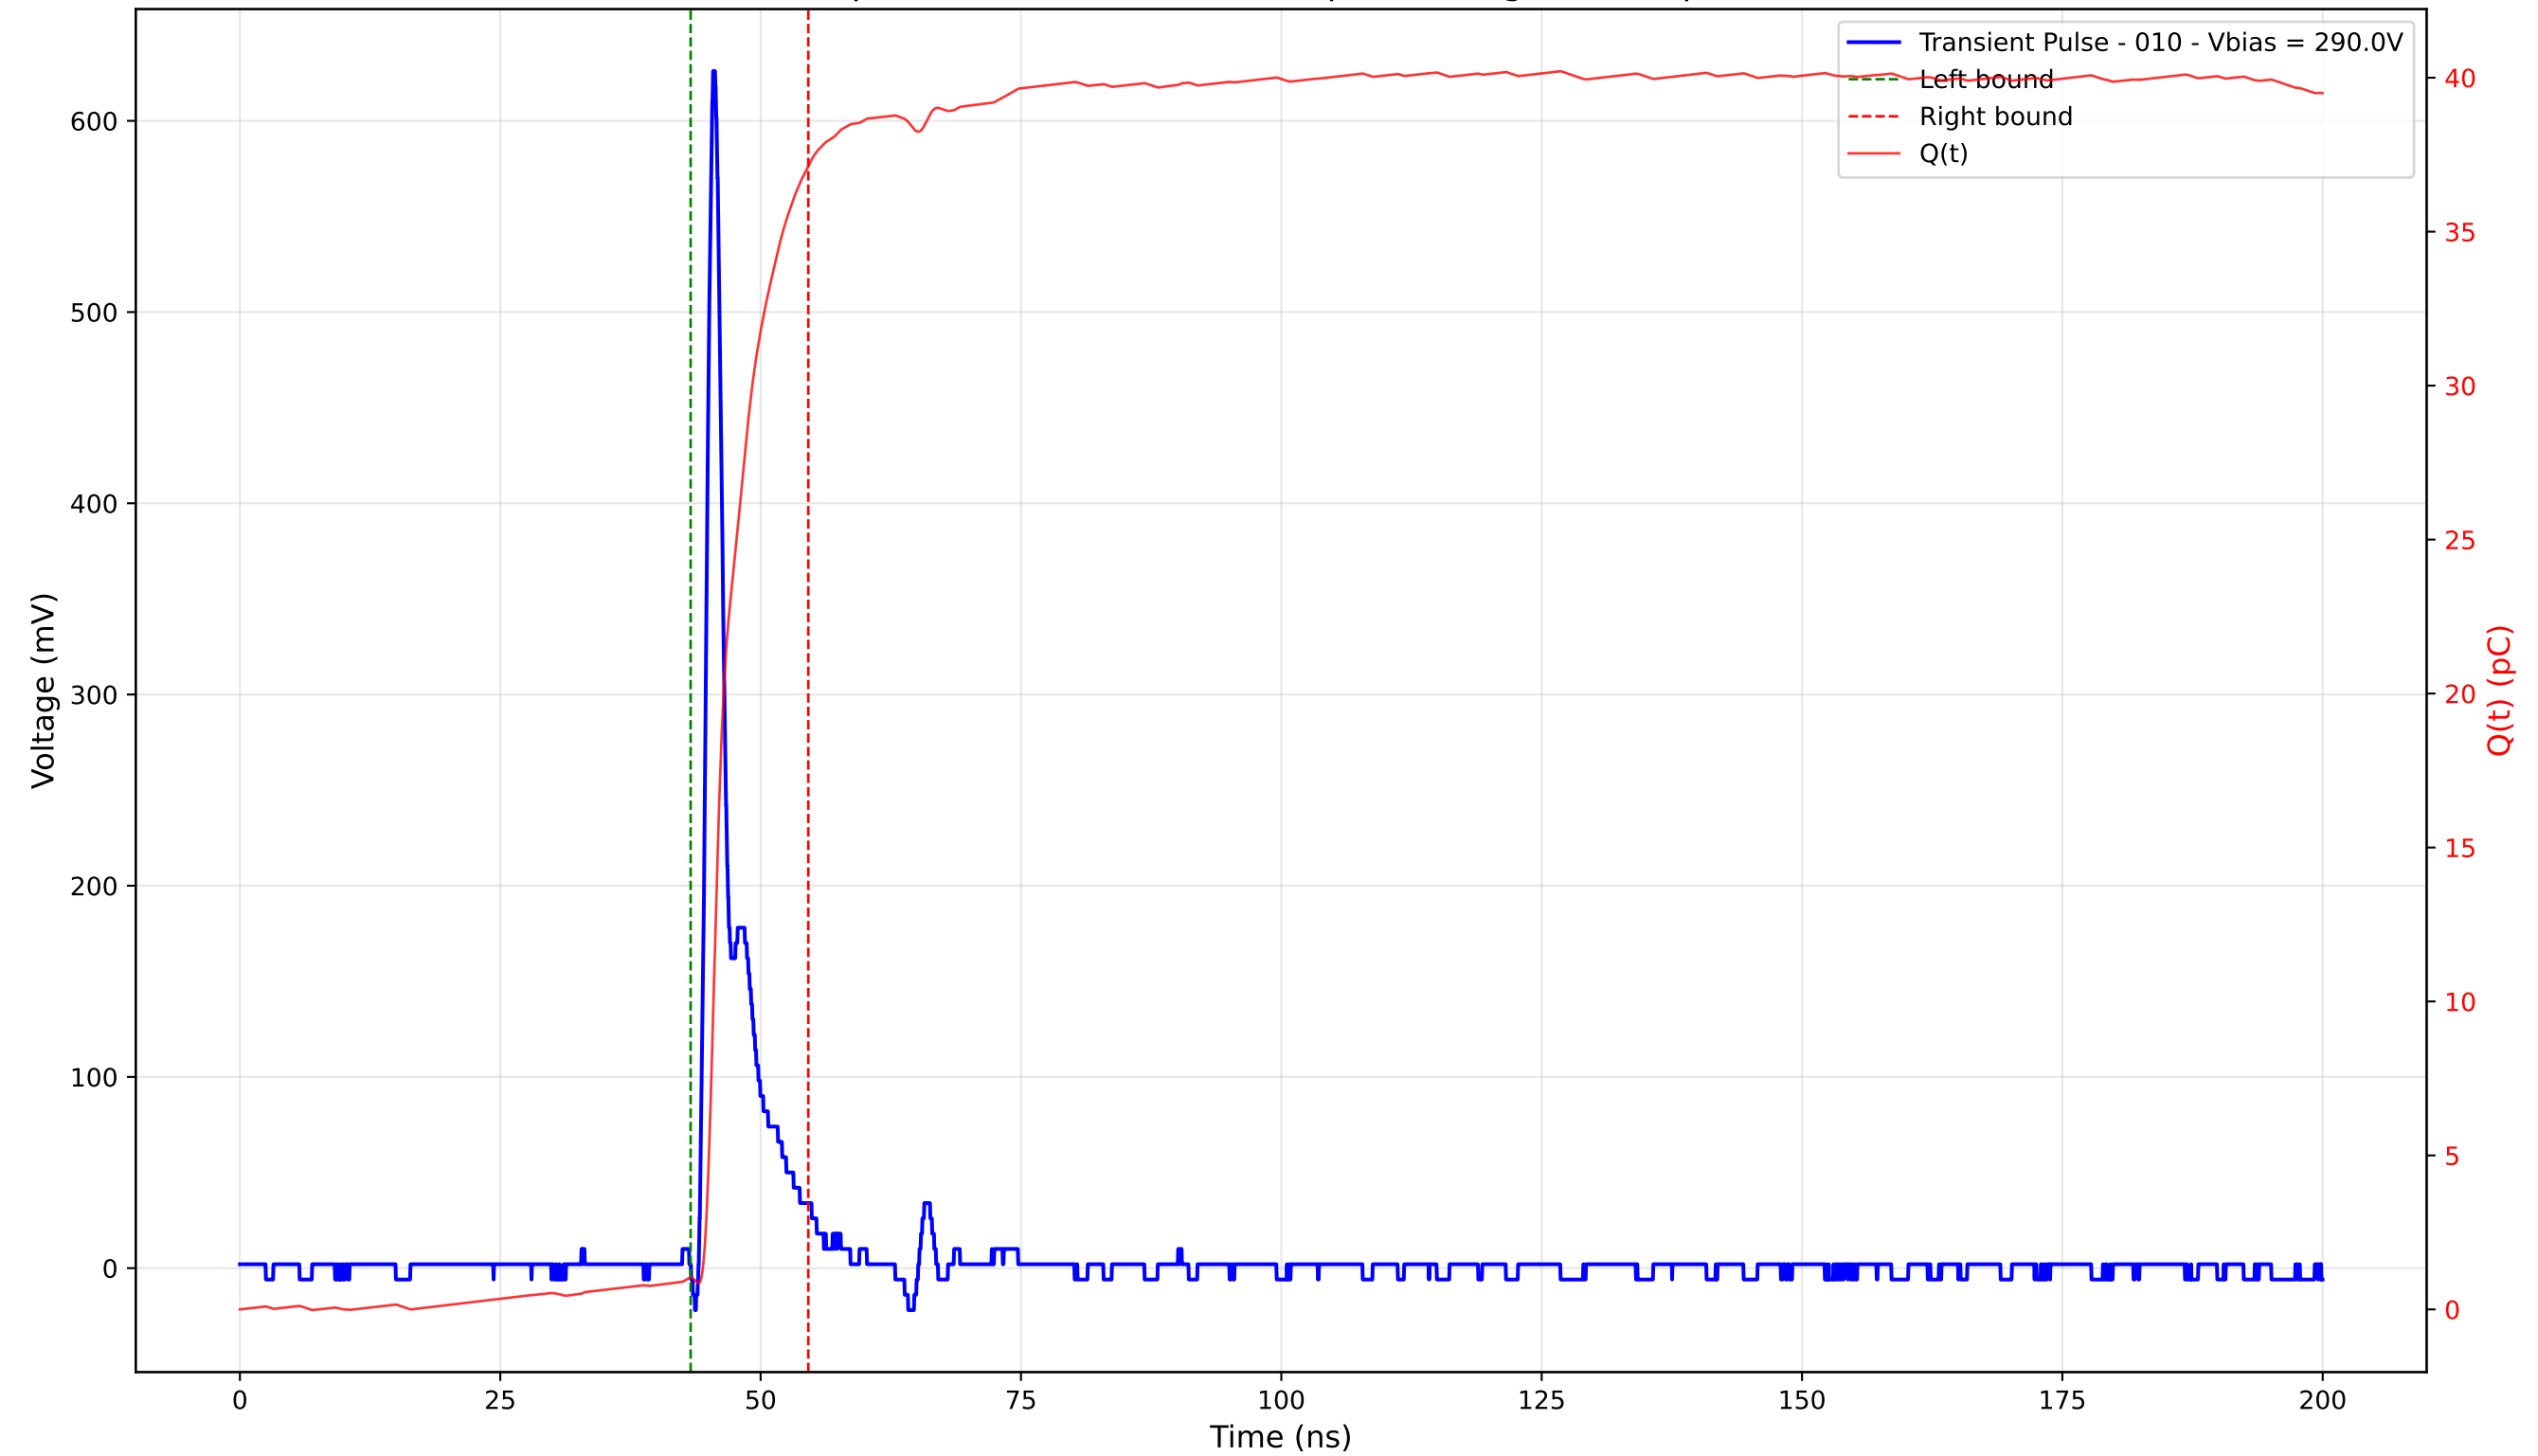


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 36.77 pC - Rise Time: 0.94 ns

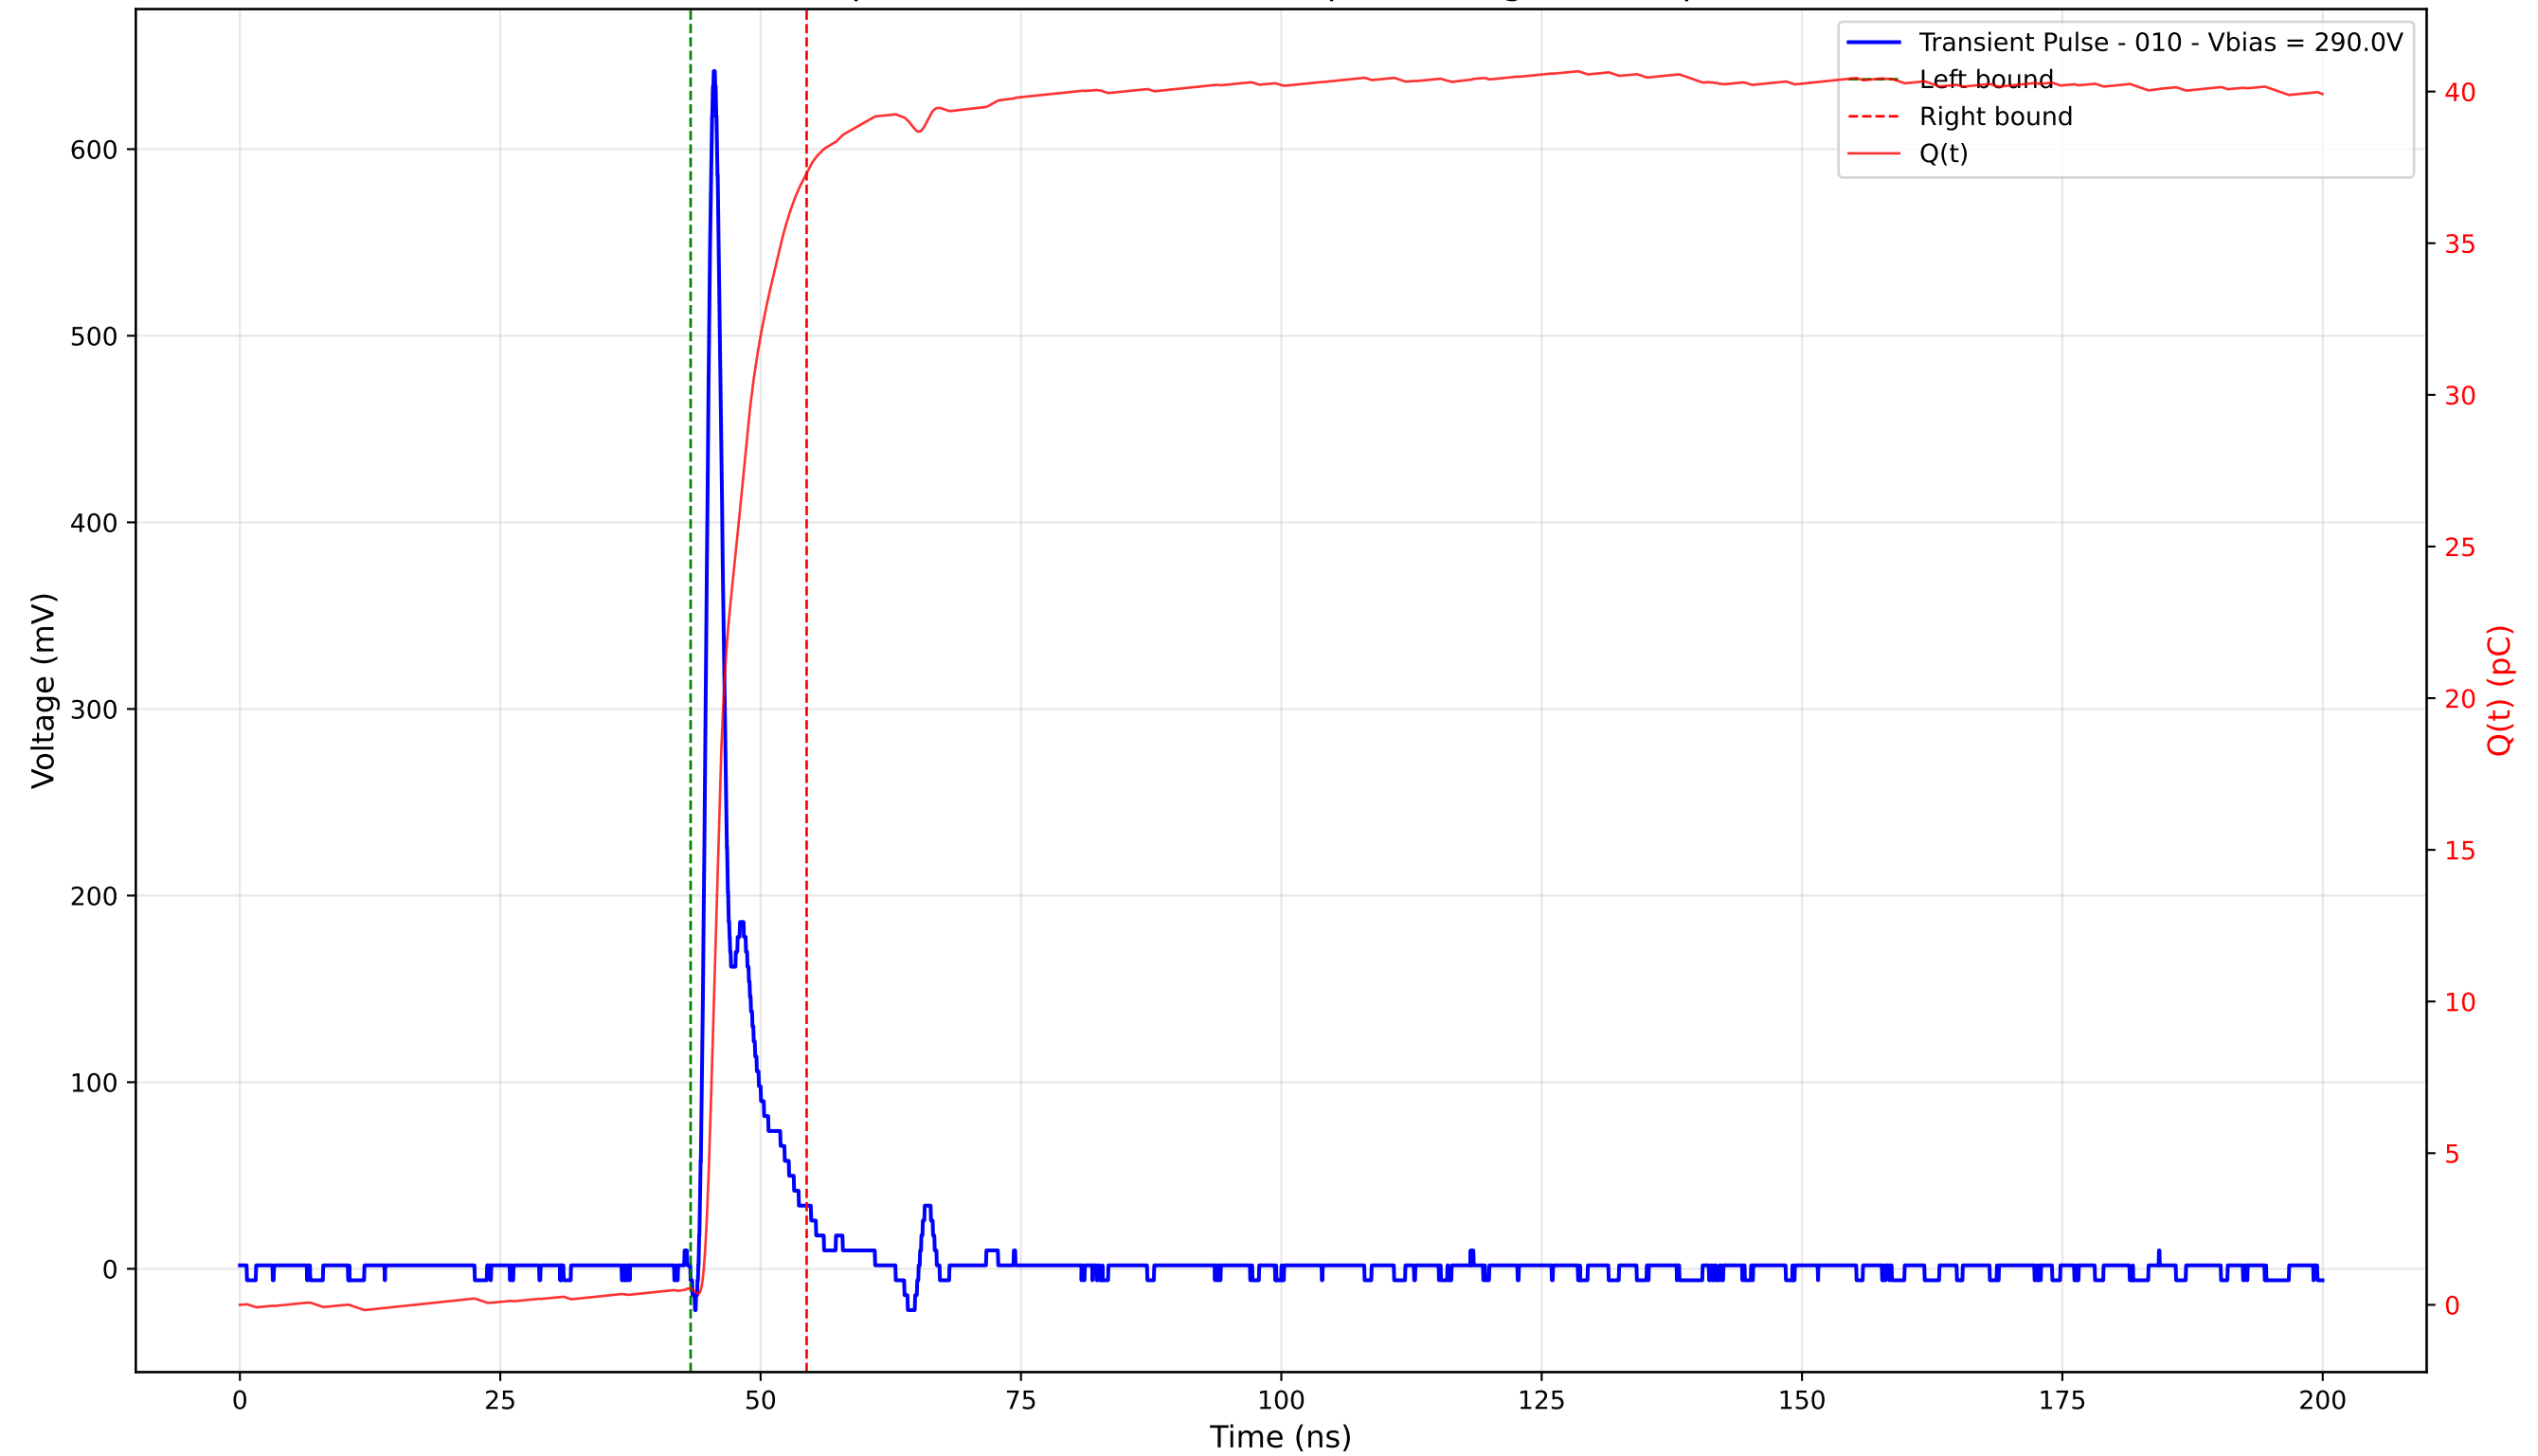


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 36.06 pC - Rise Time: 0.94 ns

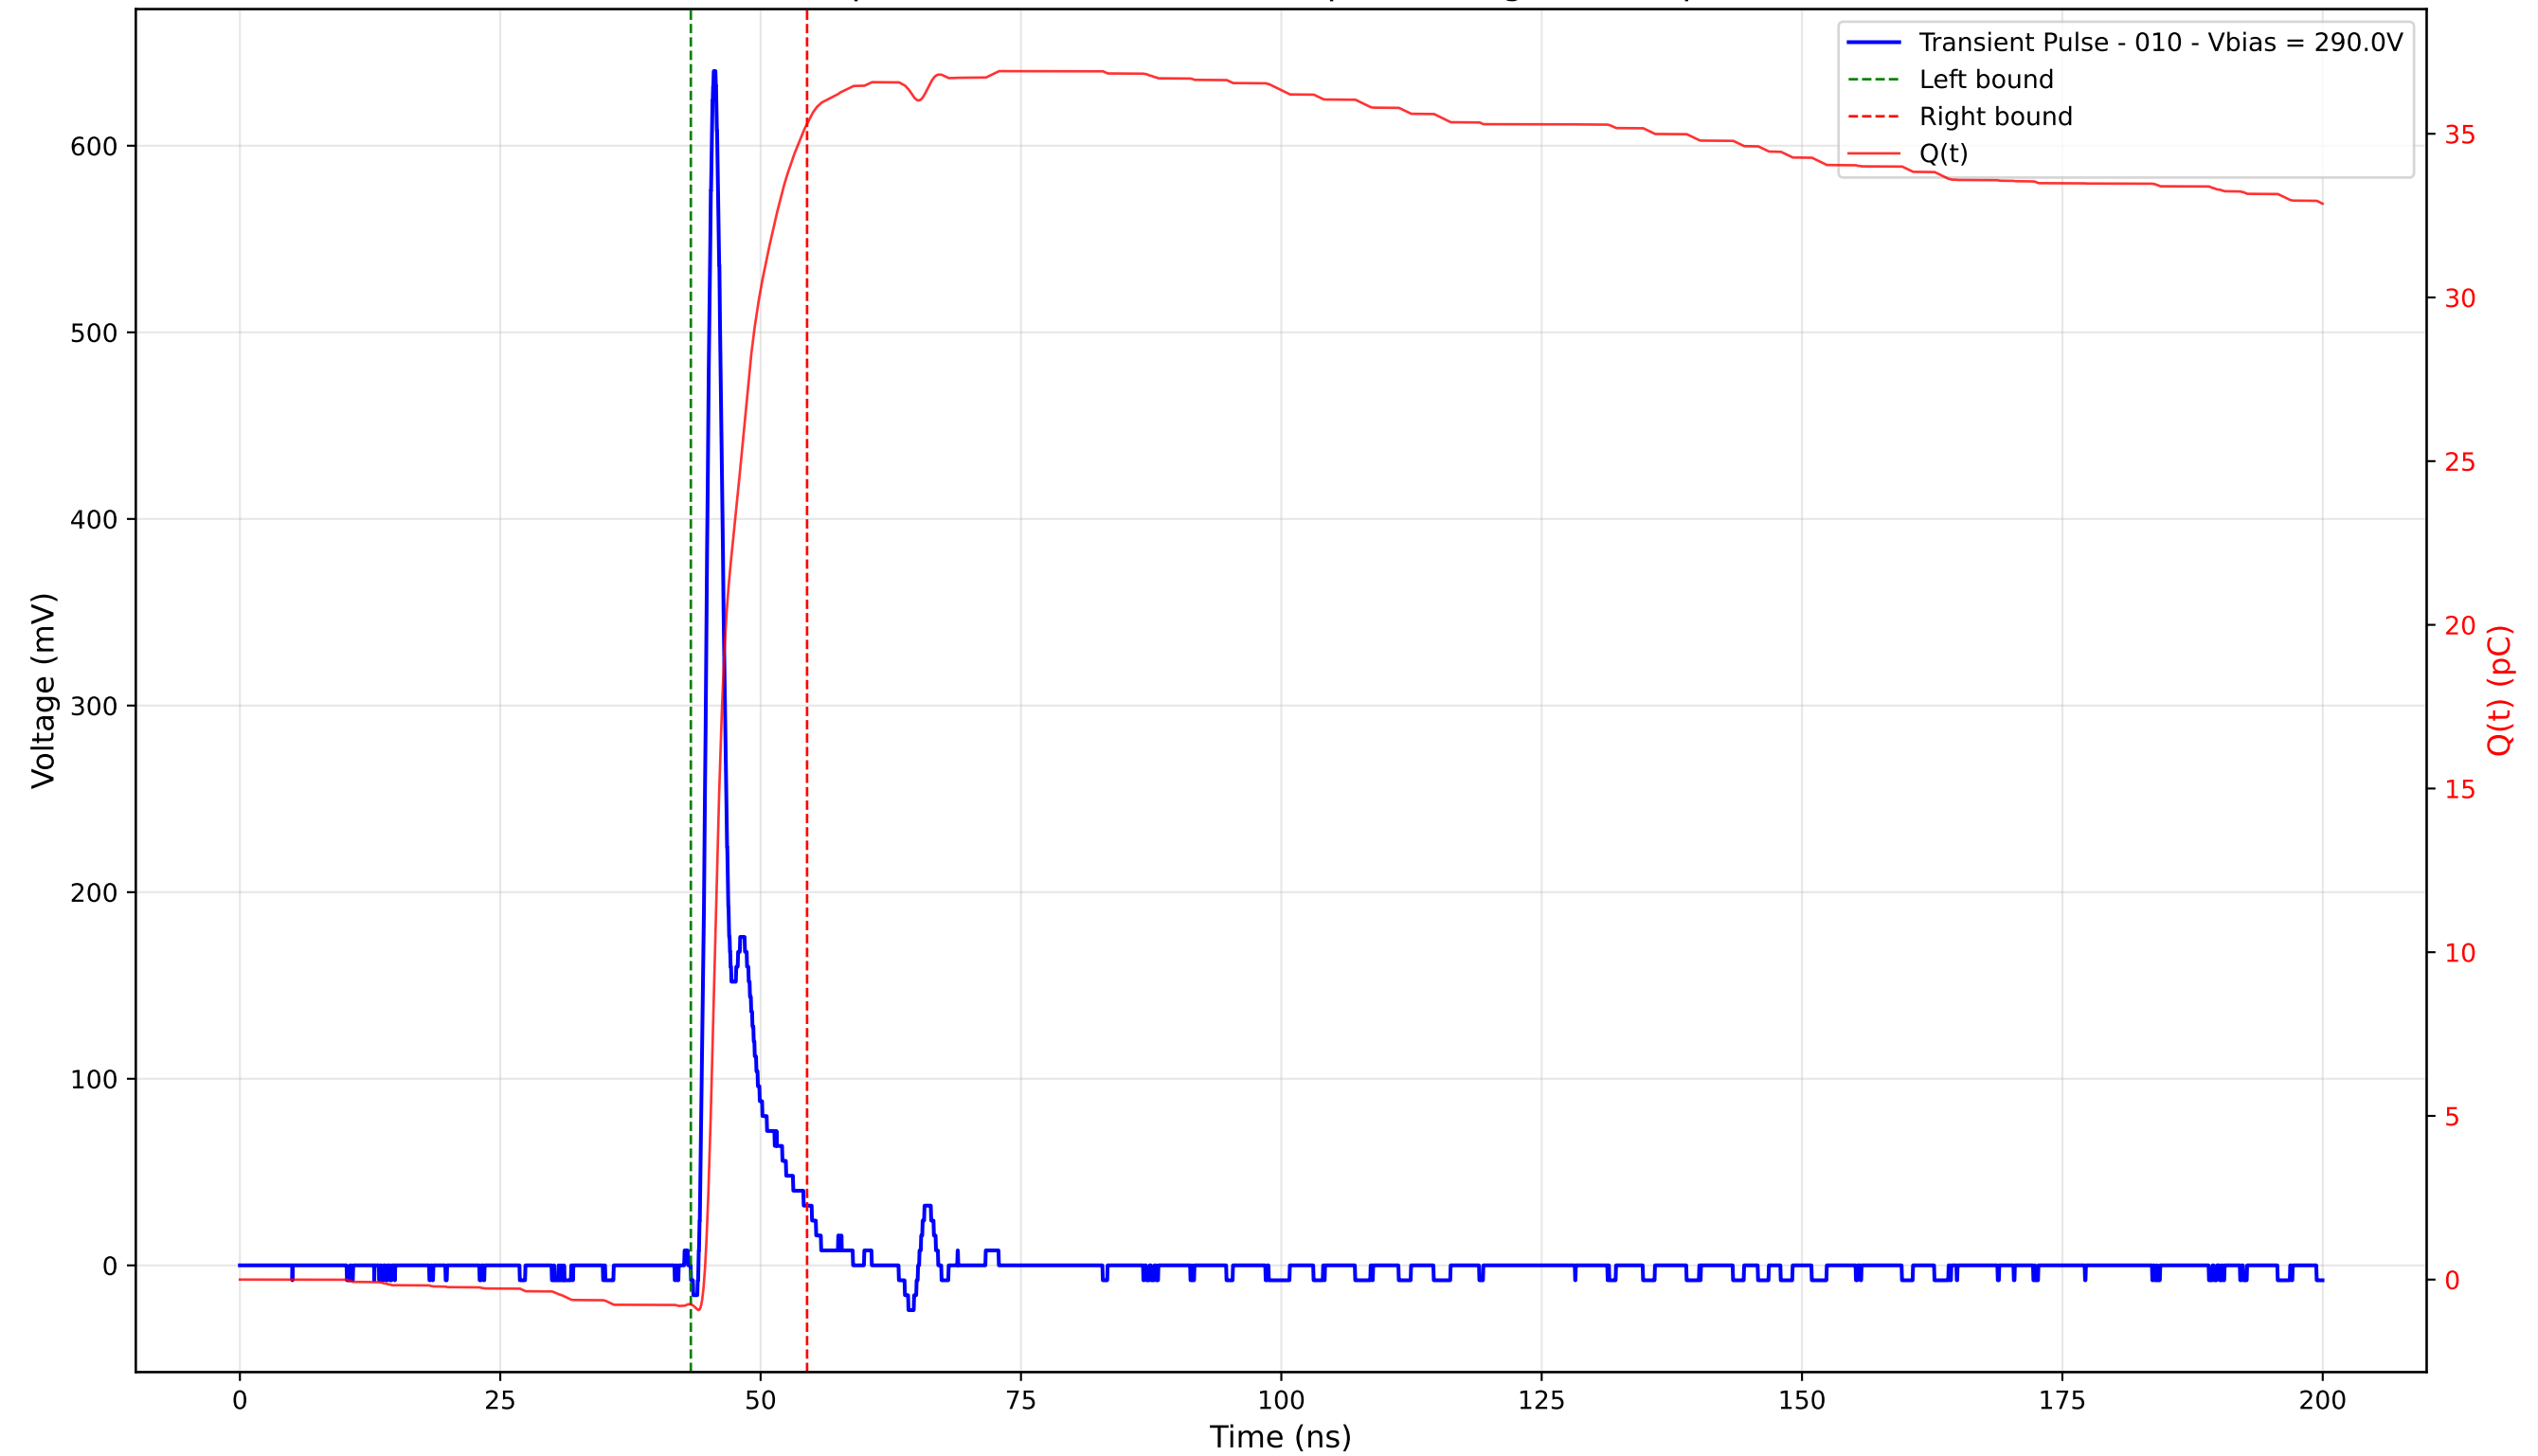


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 36.29 pC - Rise Time: 0.98 ns

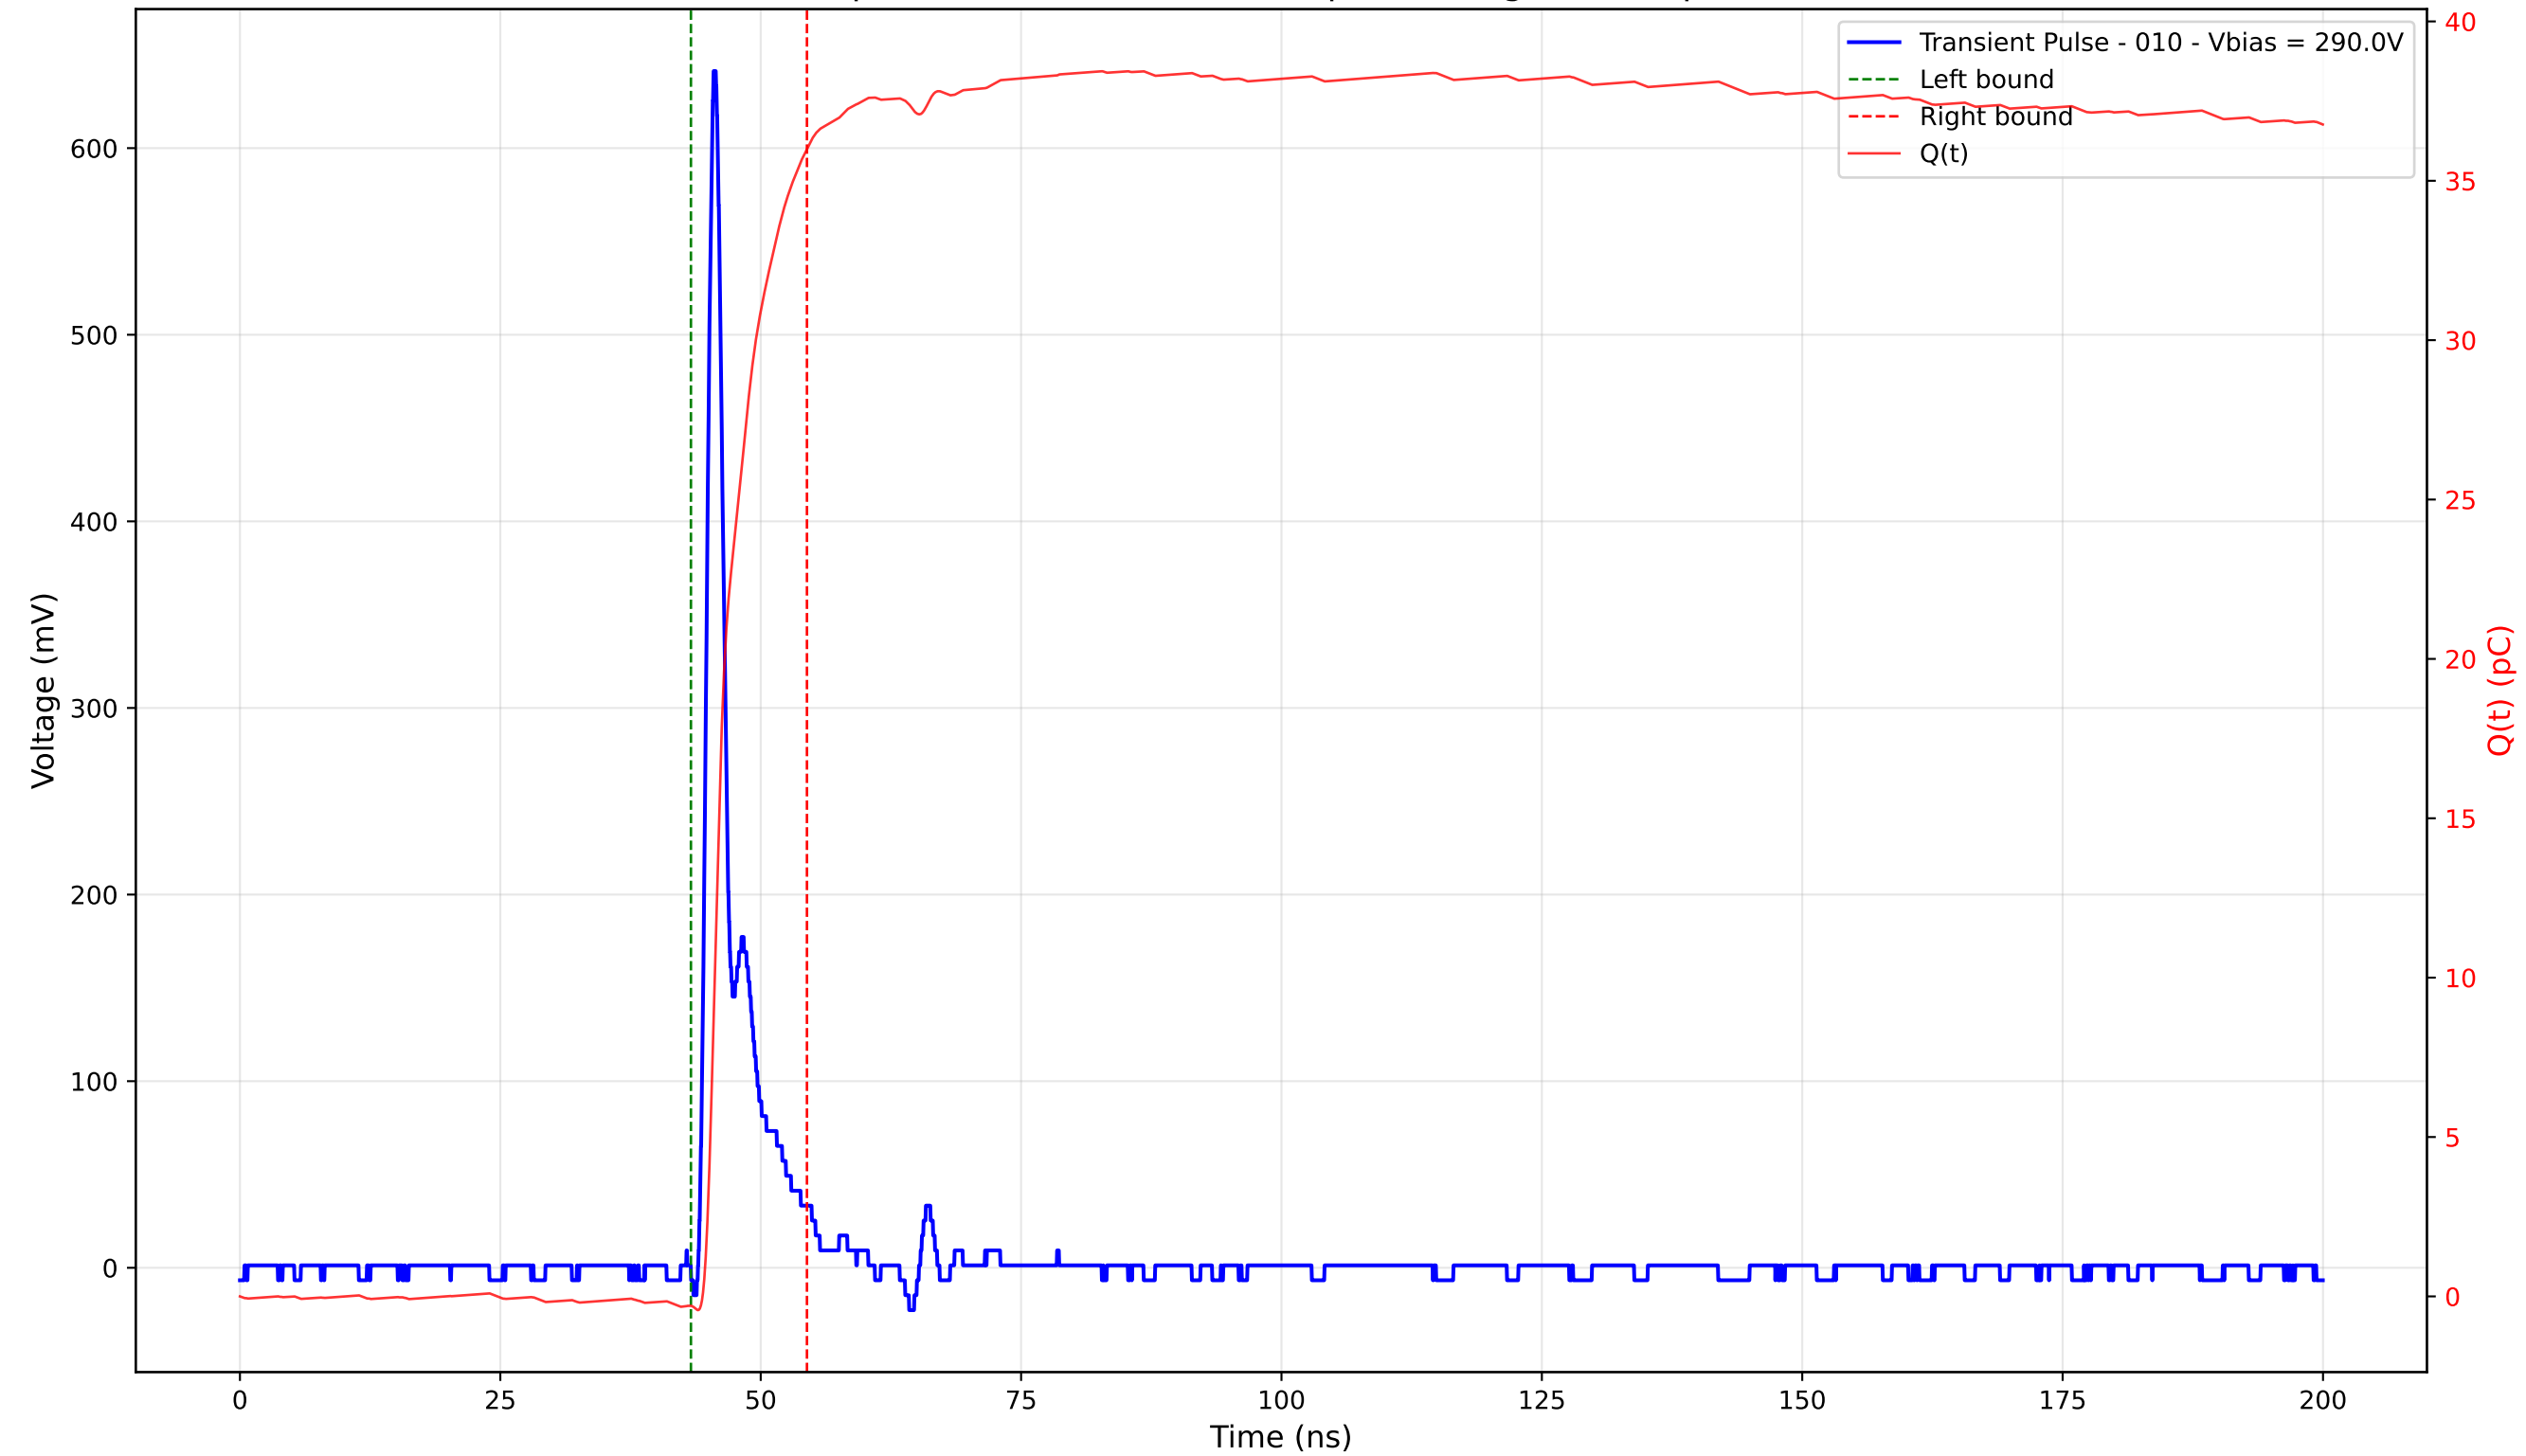


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 36.85 pC - Rise Time: 0.99 ns

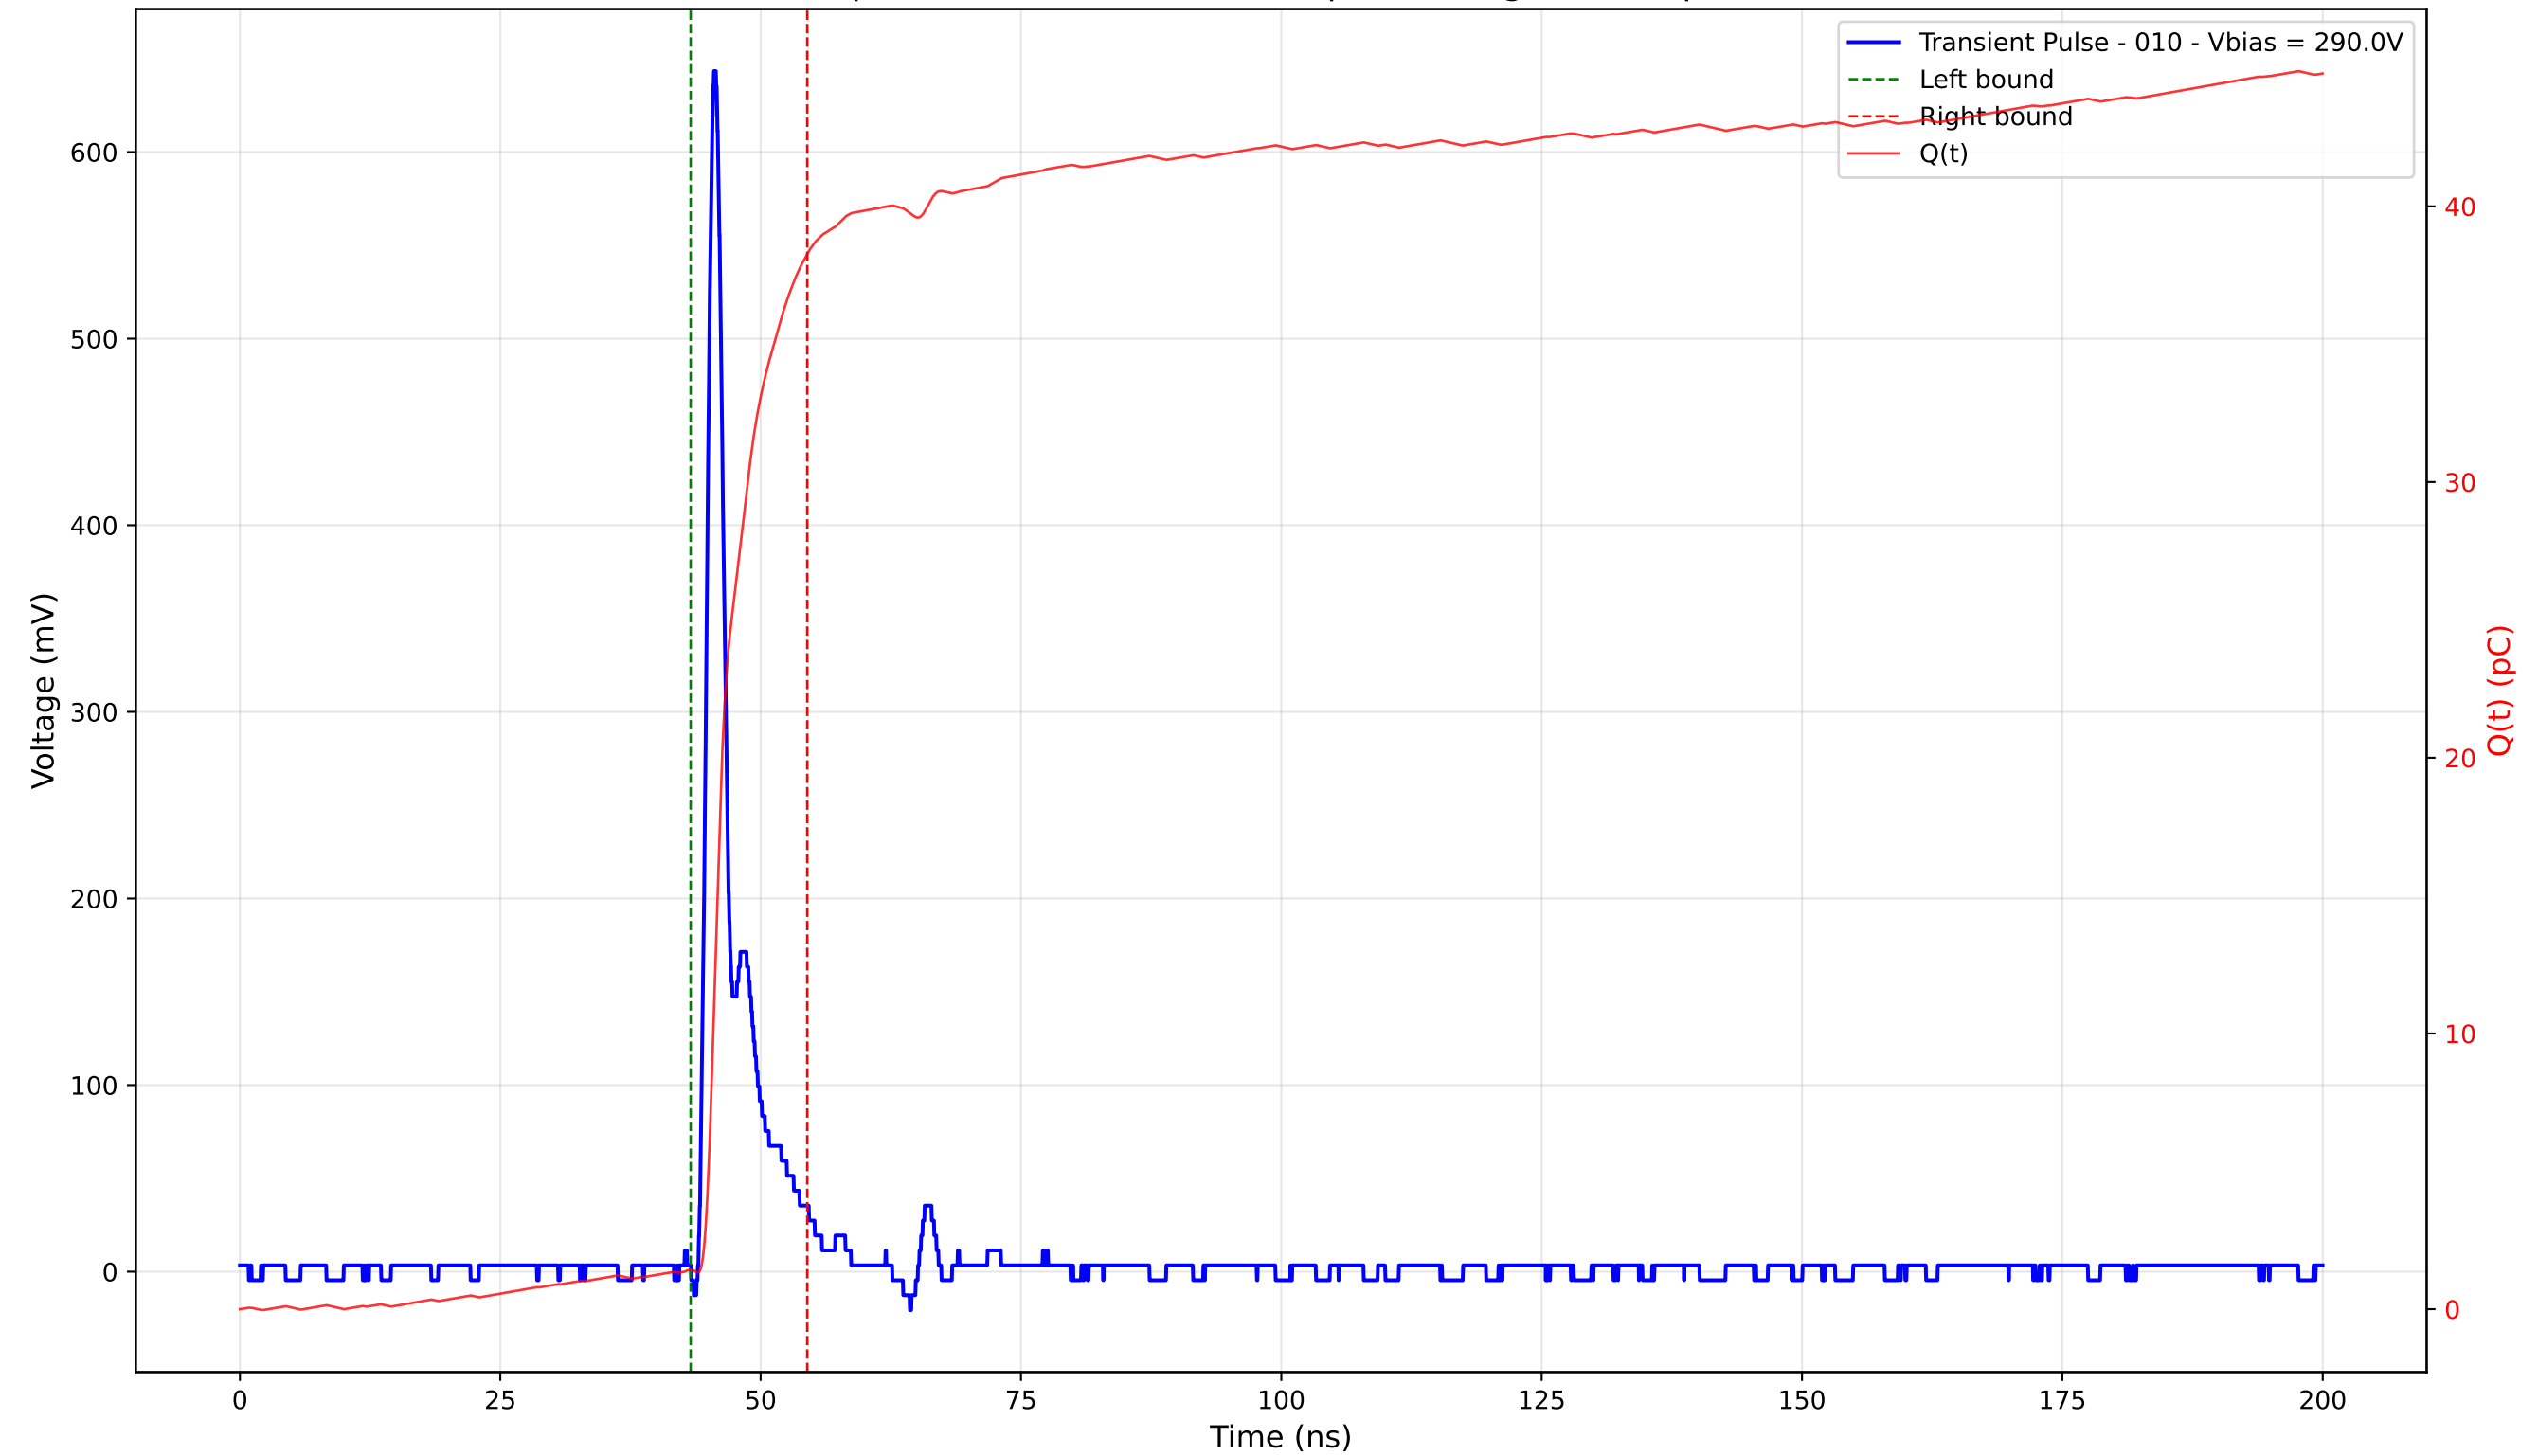


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 36.17 pC - Rise Time: 1.00 ns

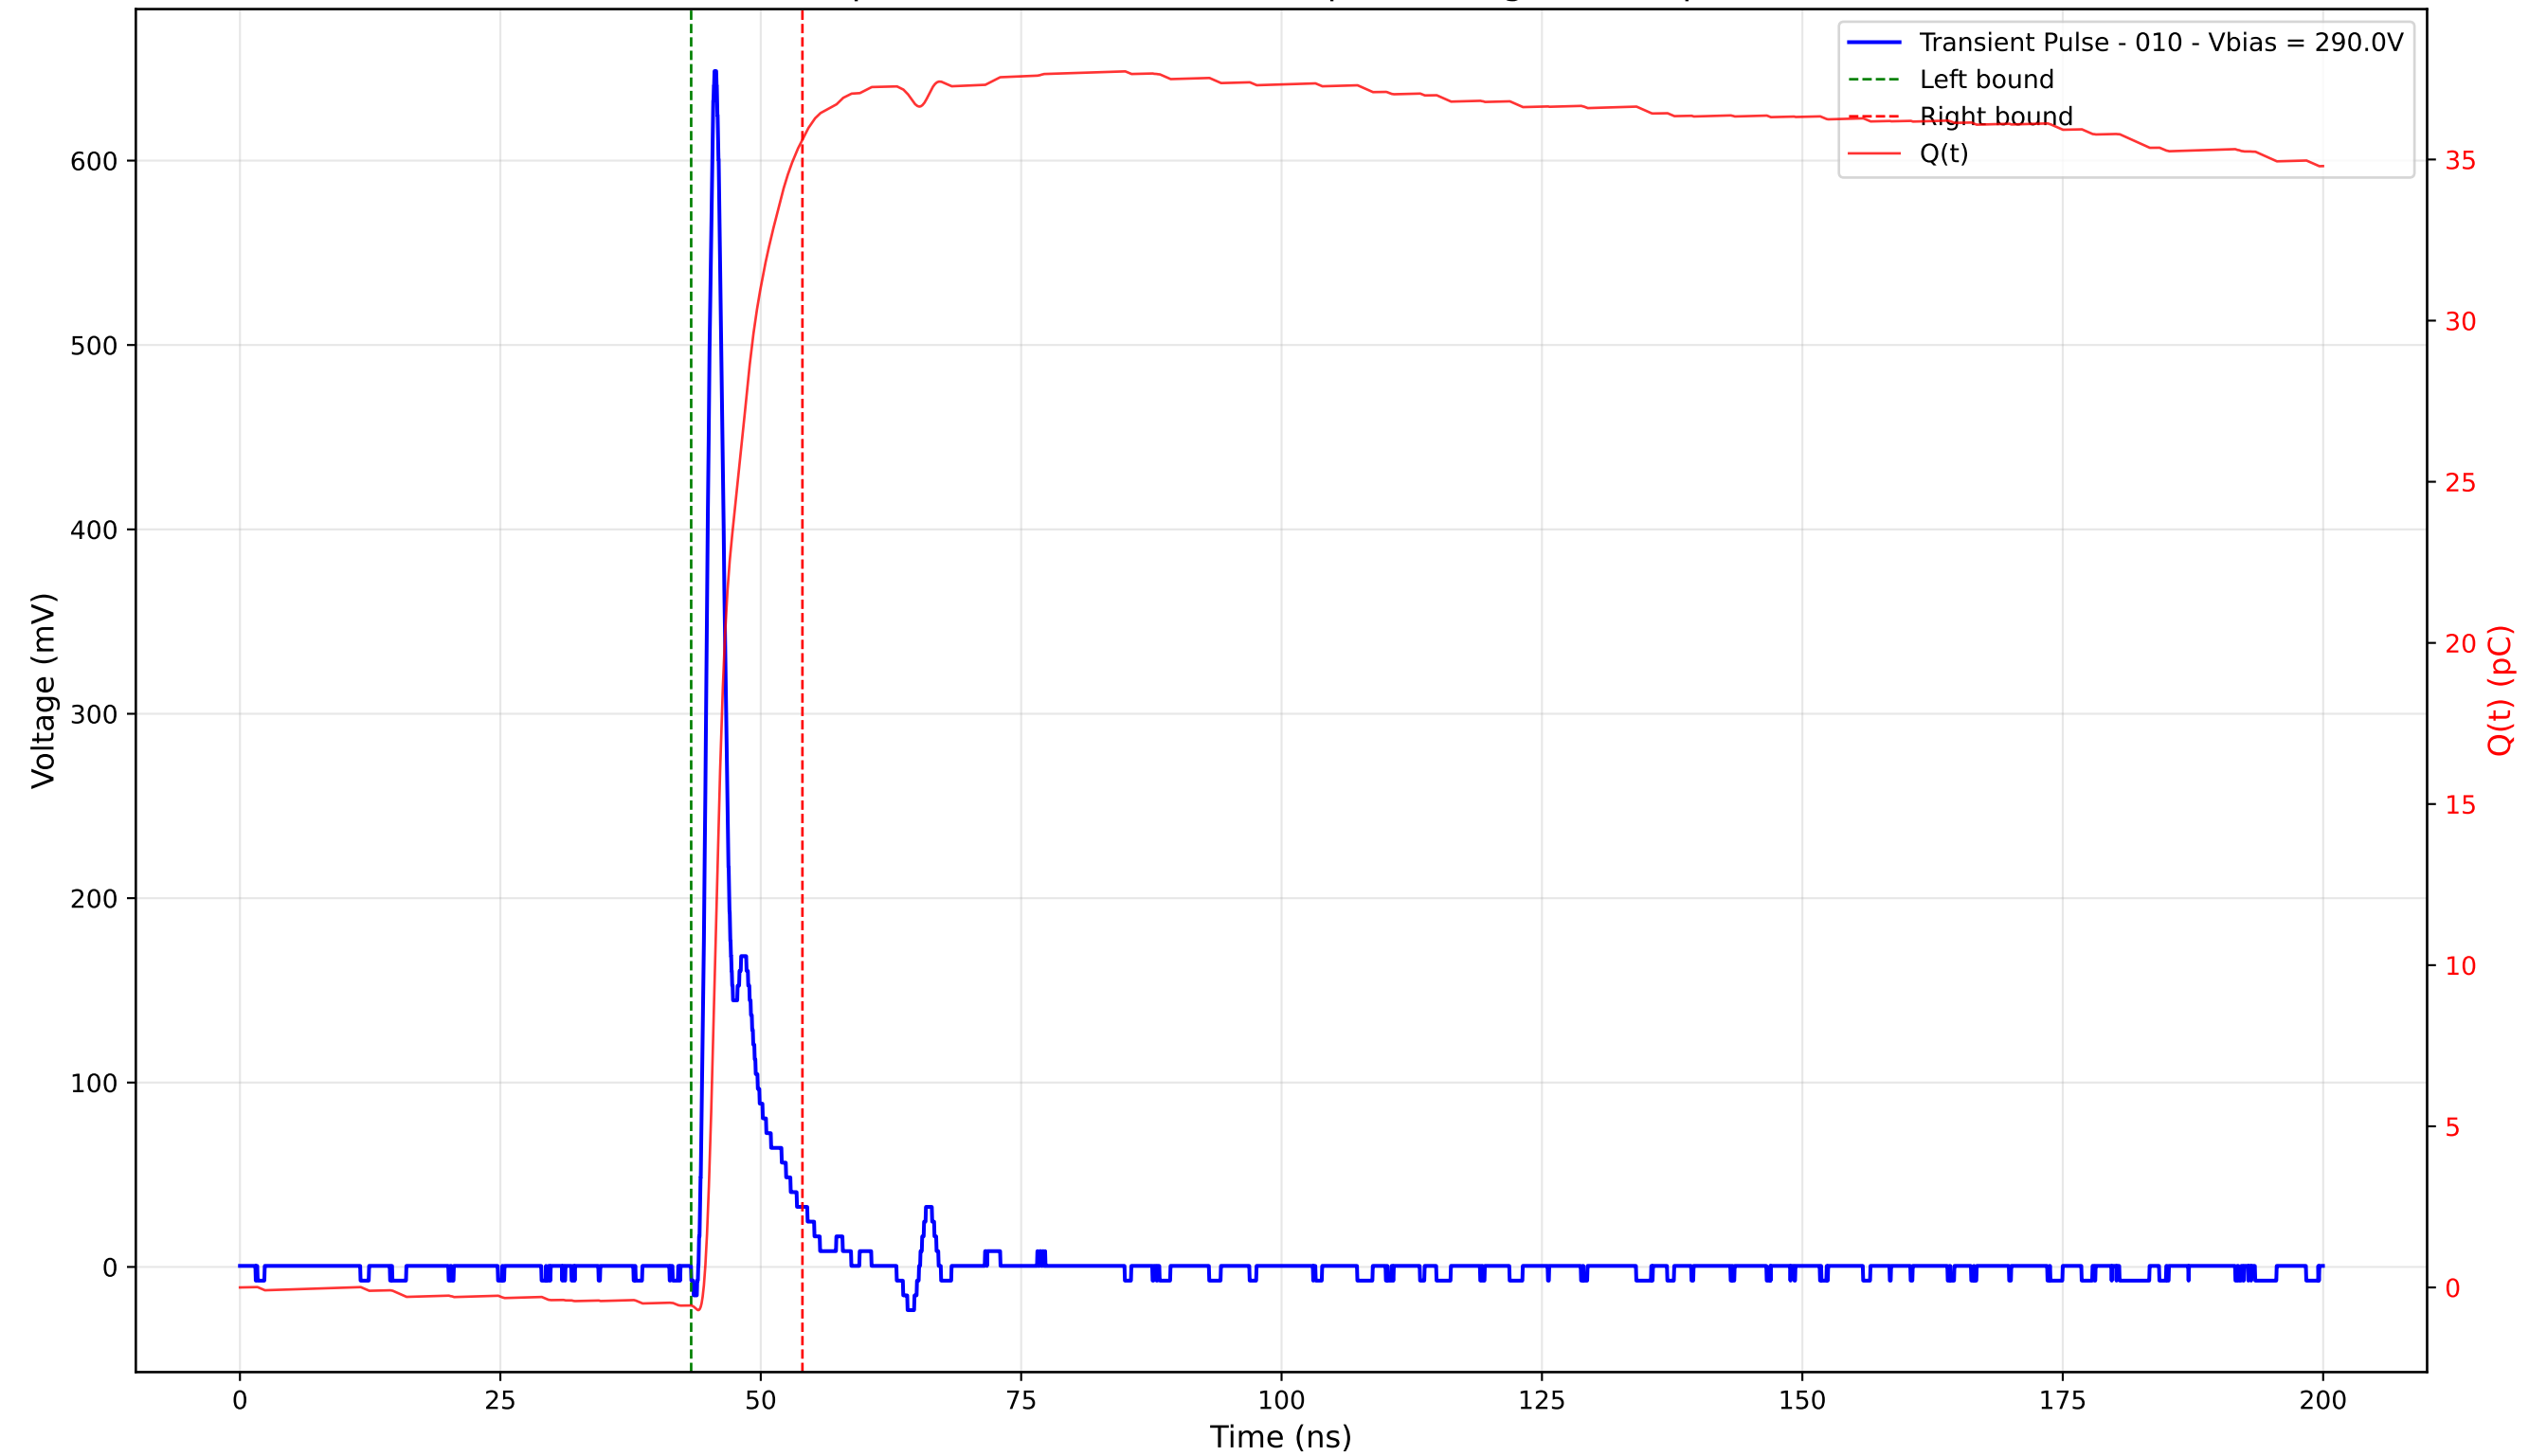


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 36.11 pC - Rise Time: 1.00 ns

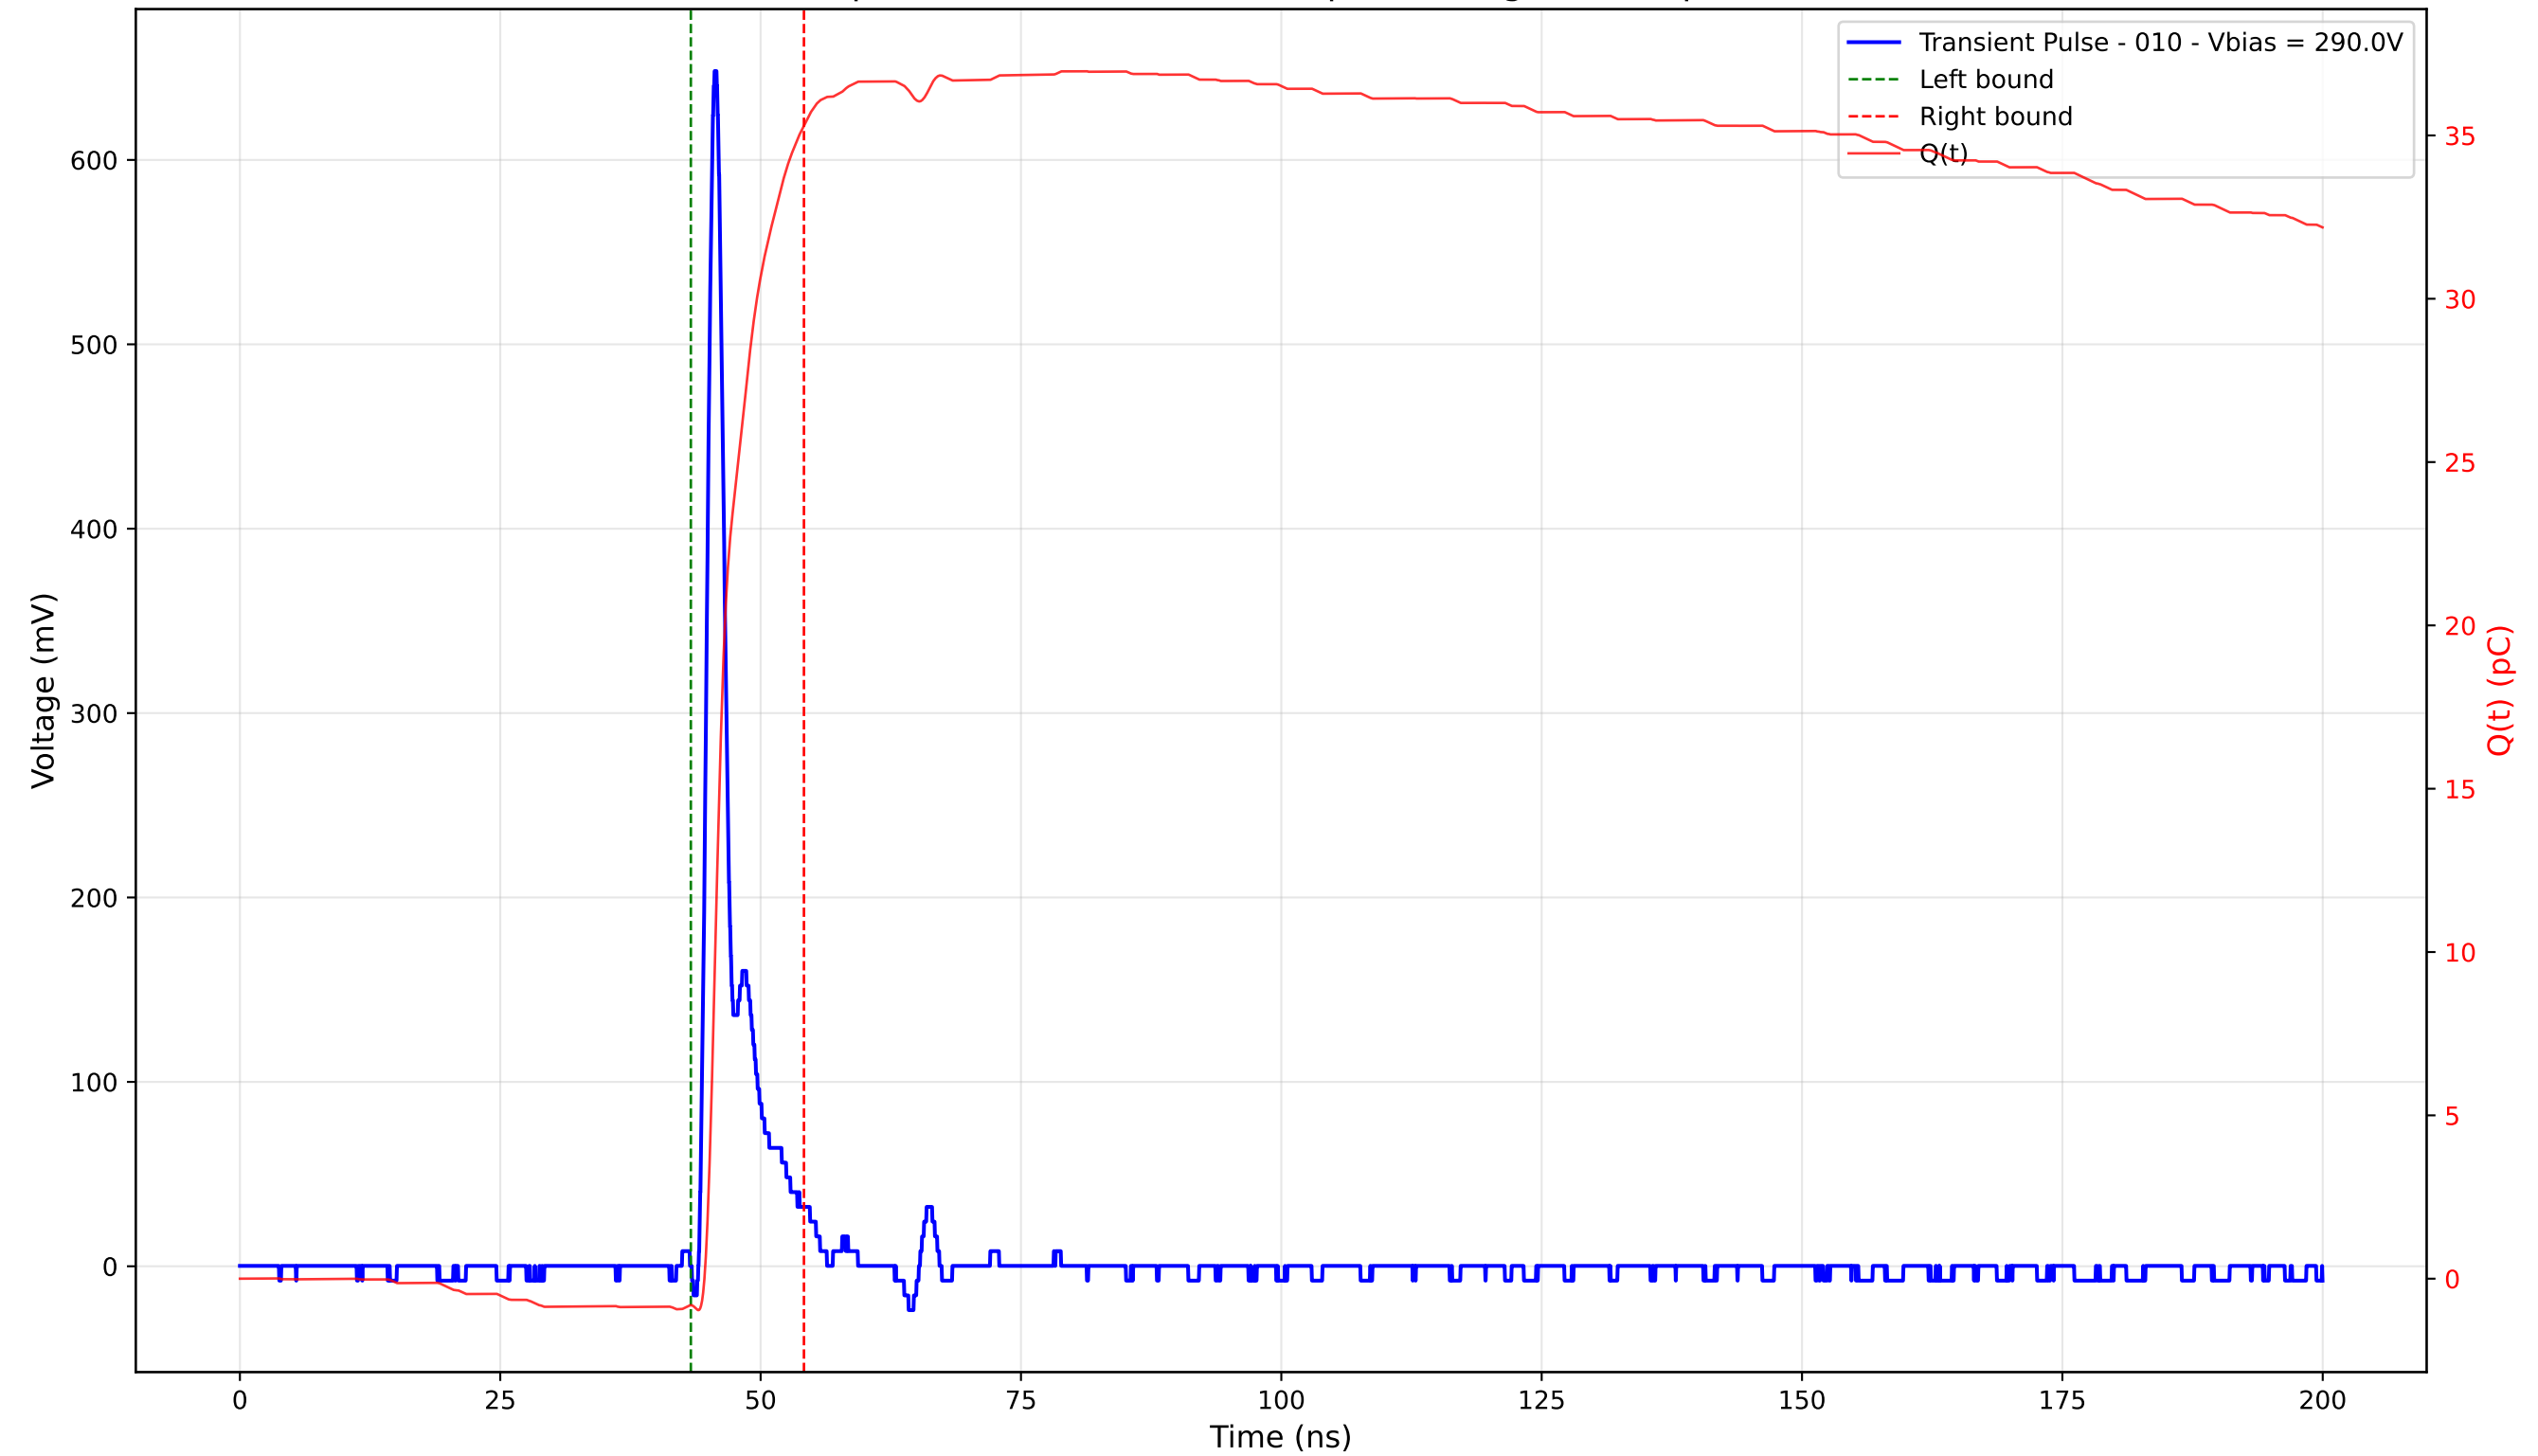


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 36.28 pC - Rise Time: 1.01 ns

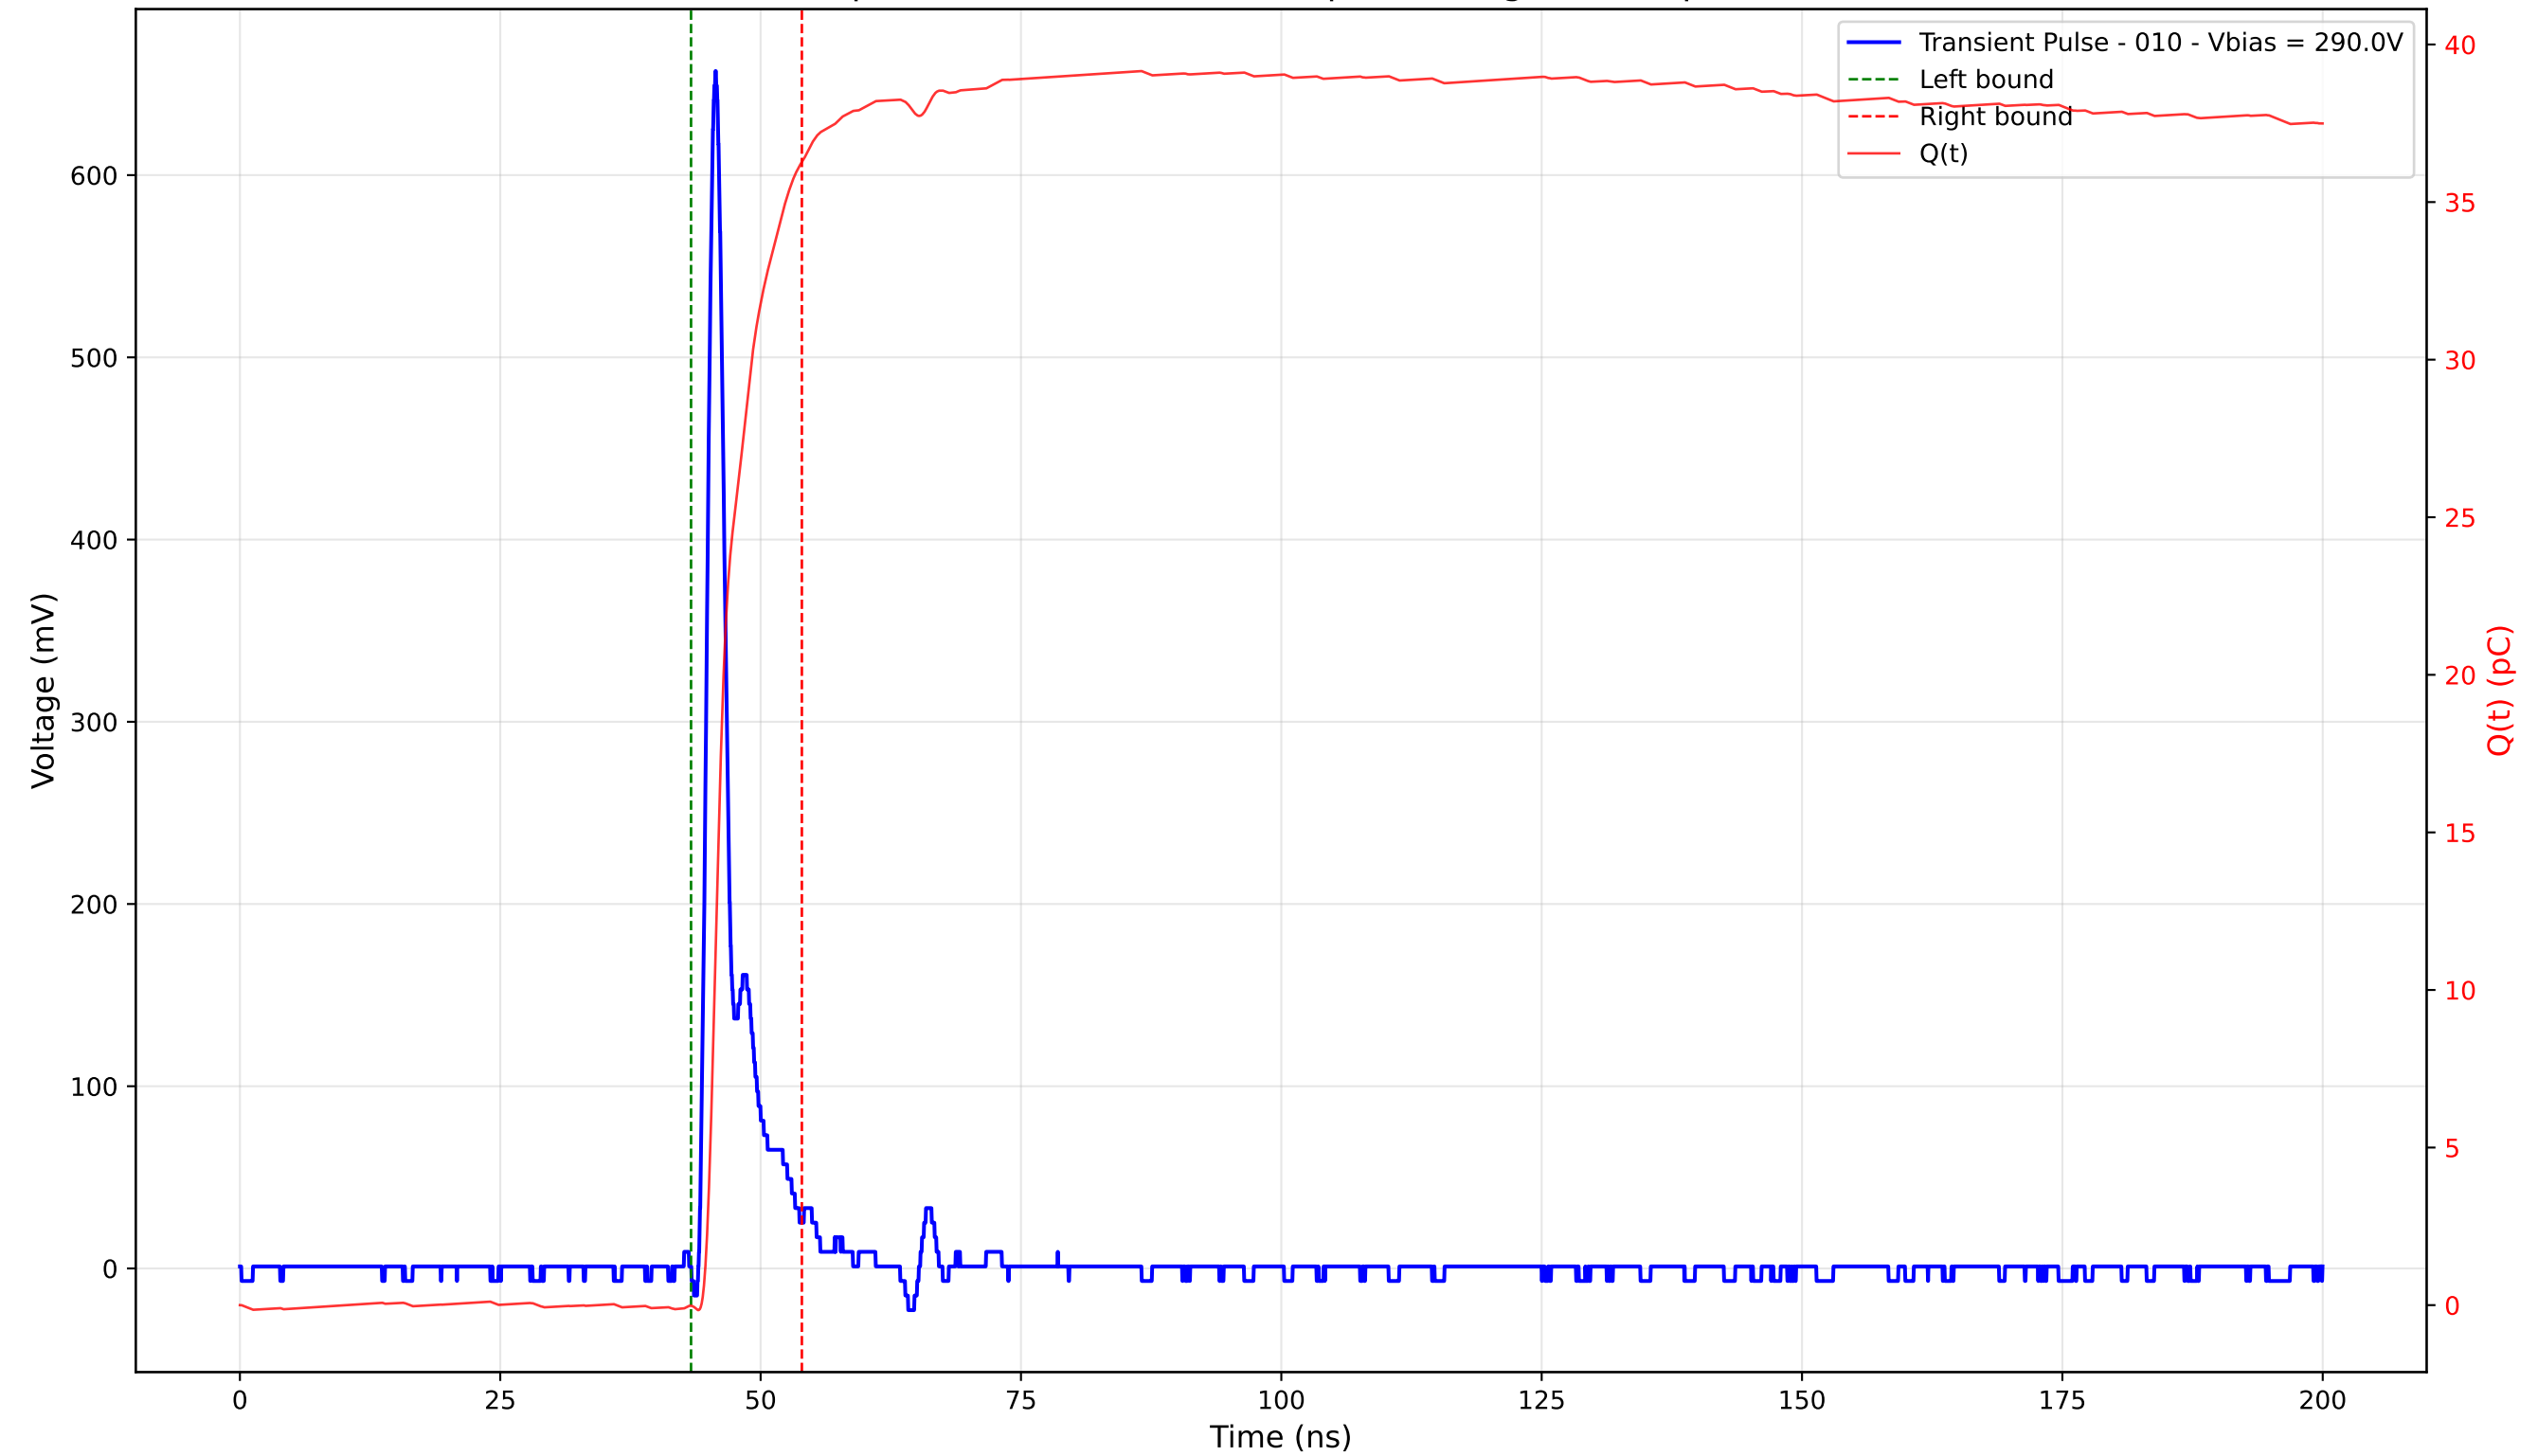


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 36.45 pC - Rise Time: 1.02 ns

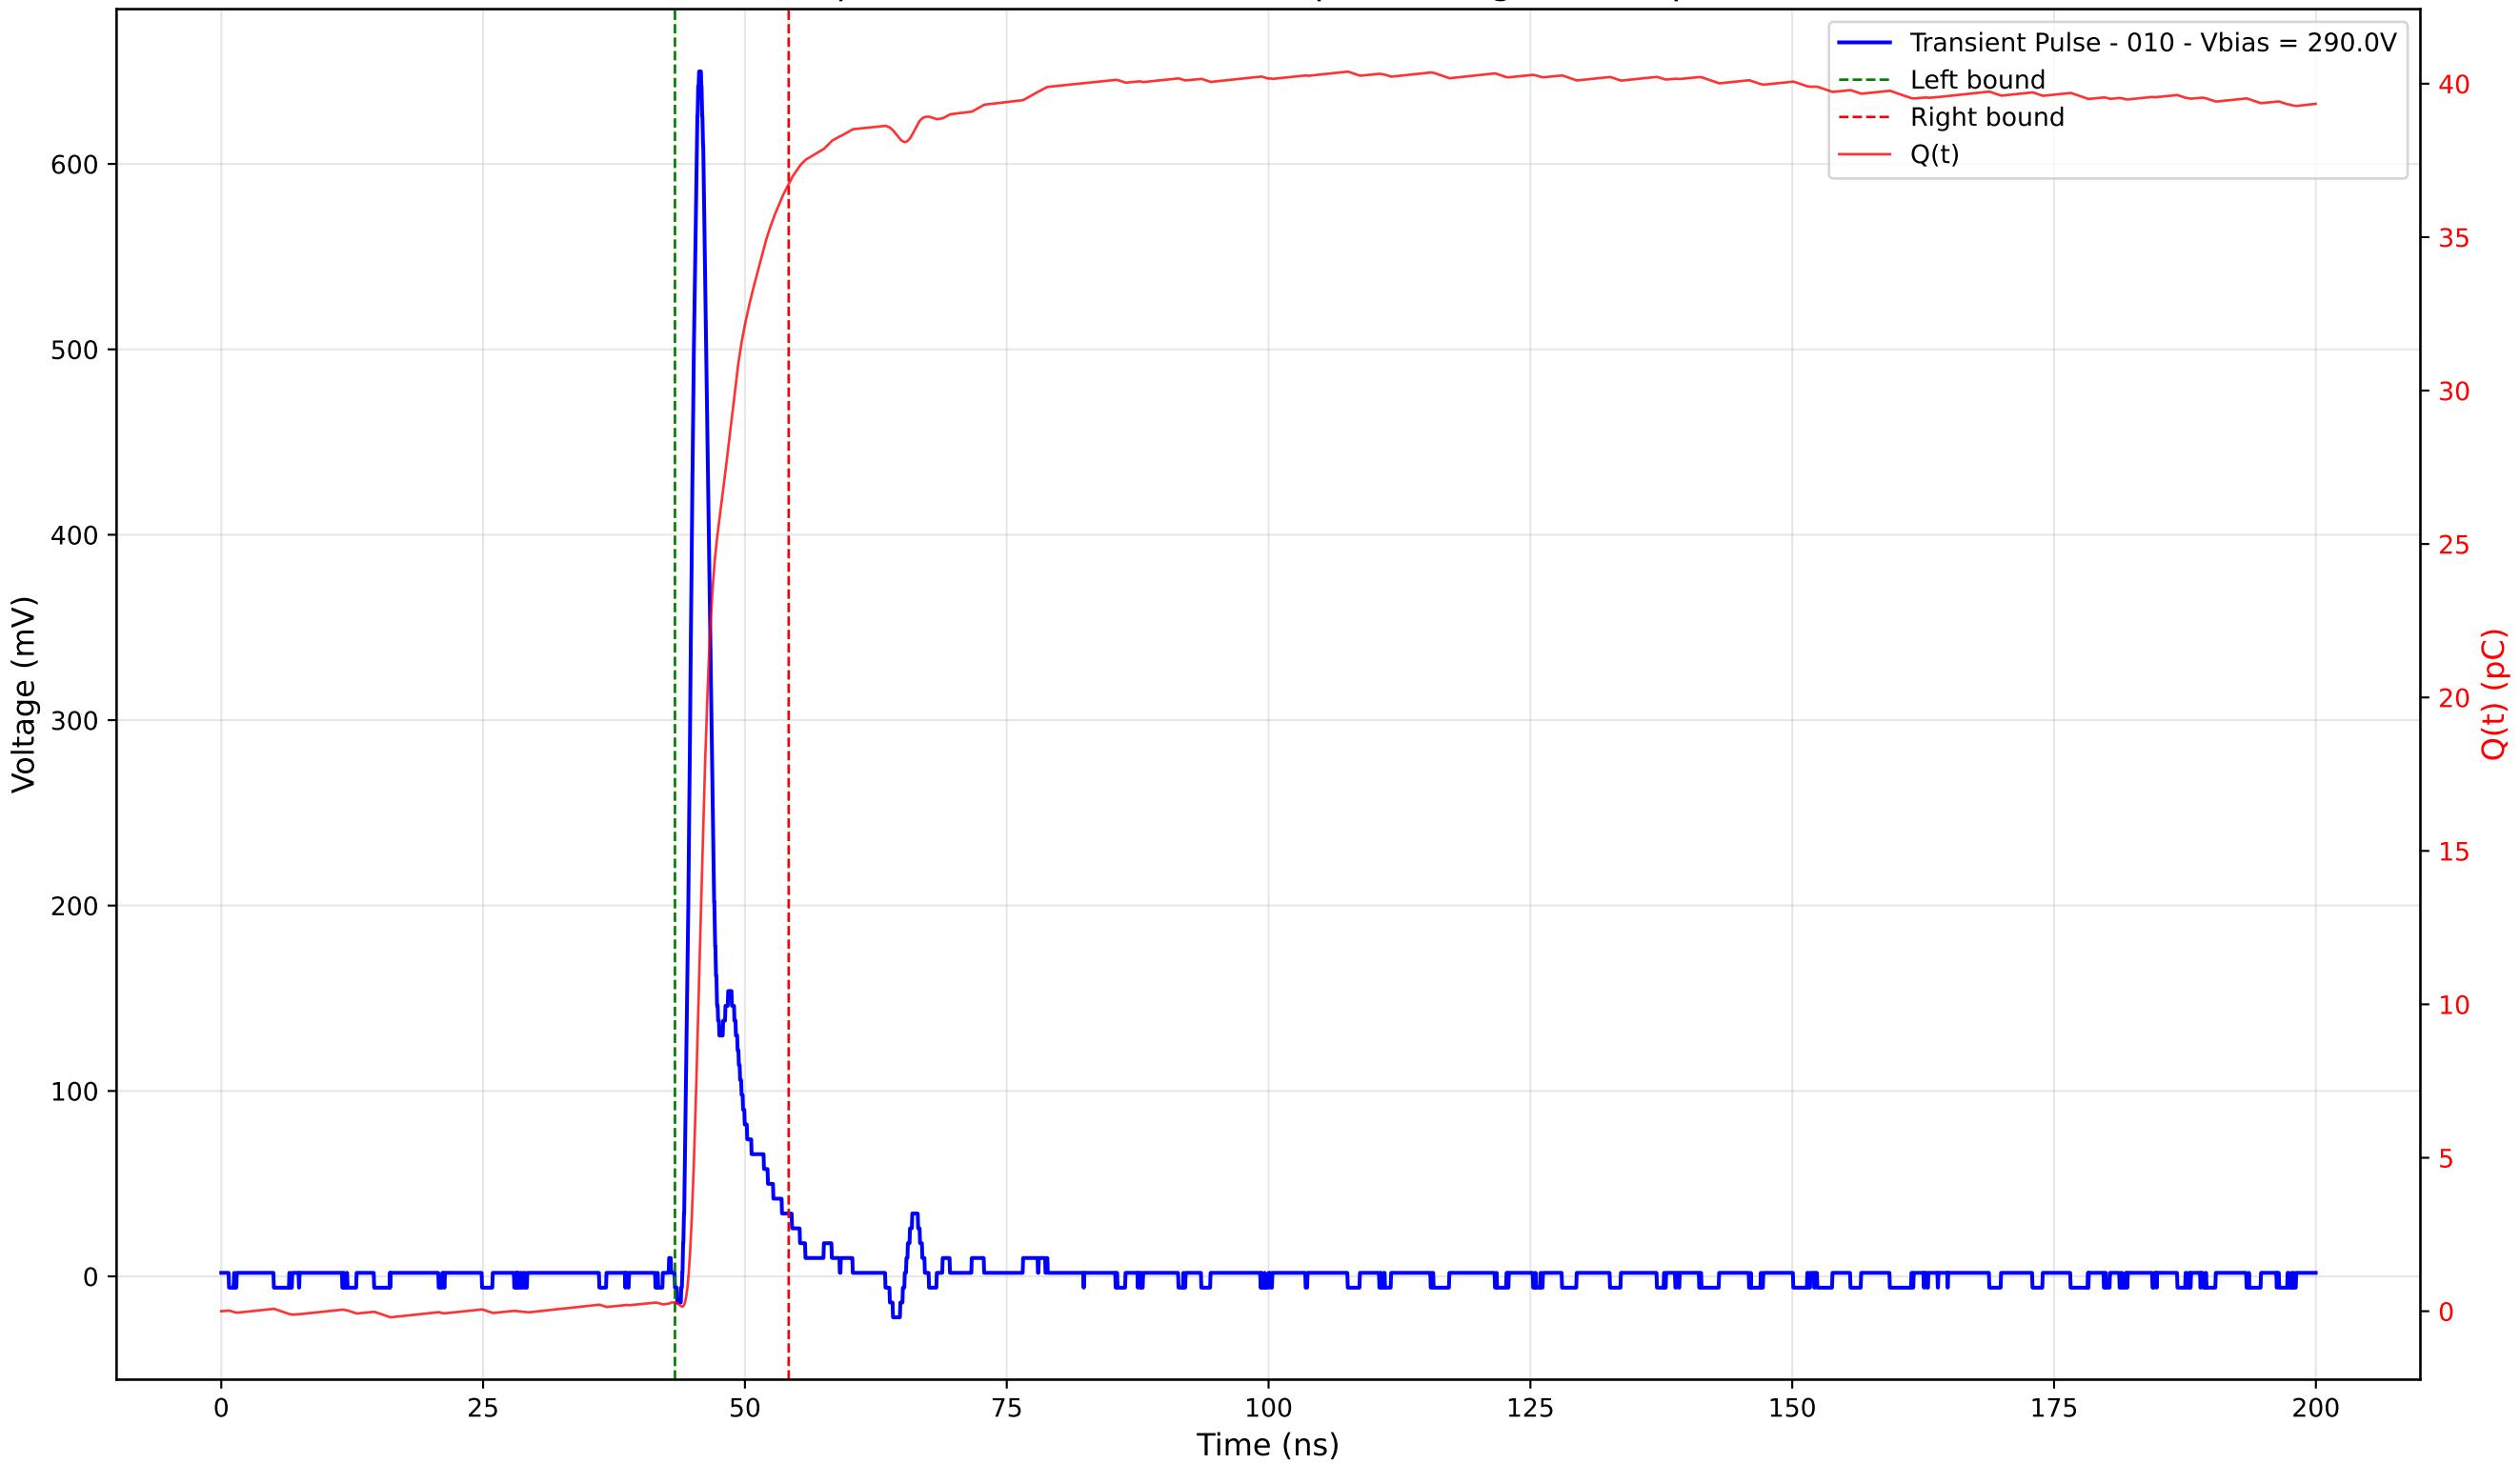


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 35.91 pC - Rise Time: 1.04 ns

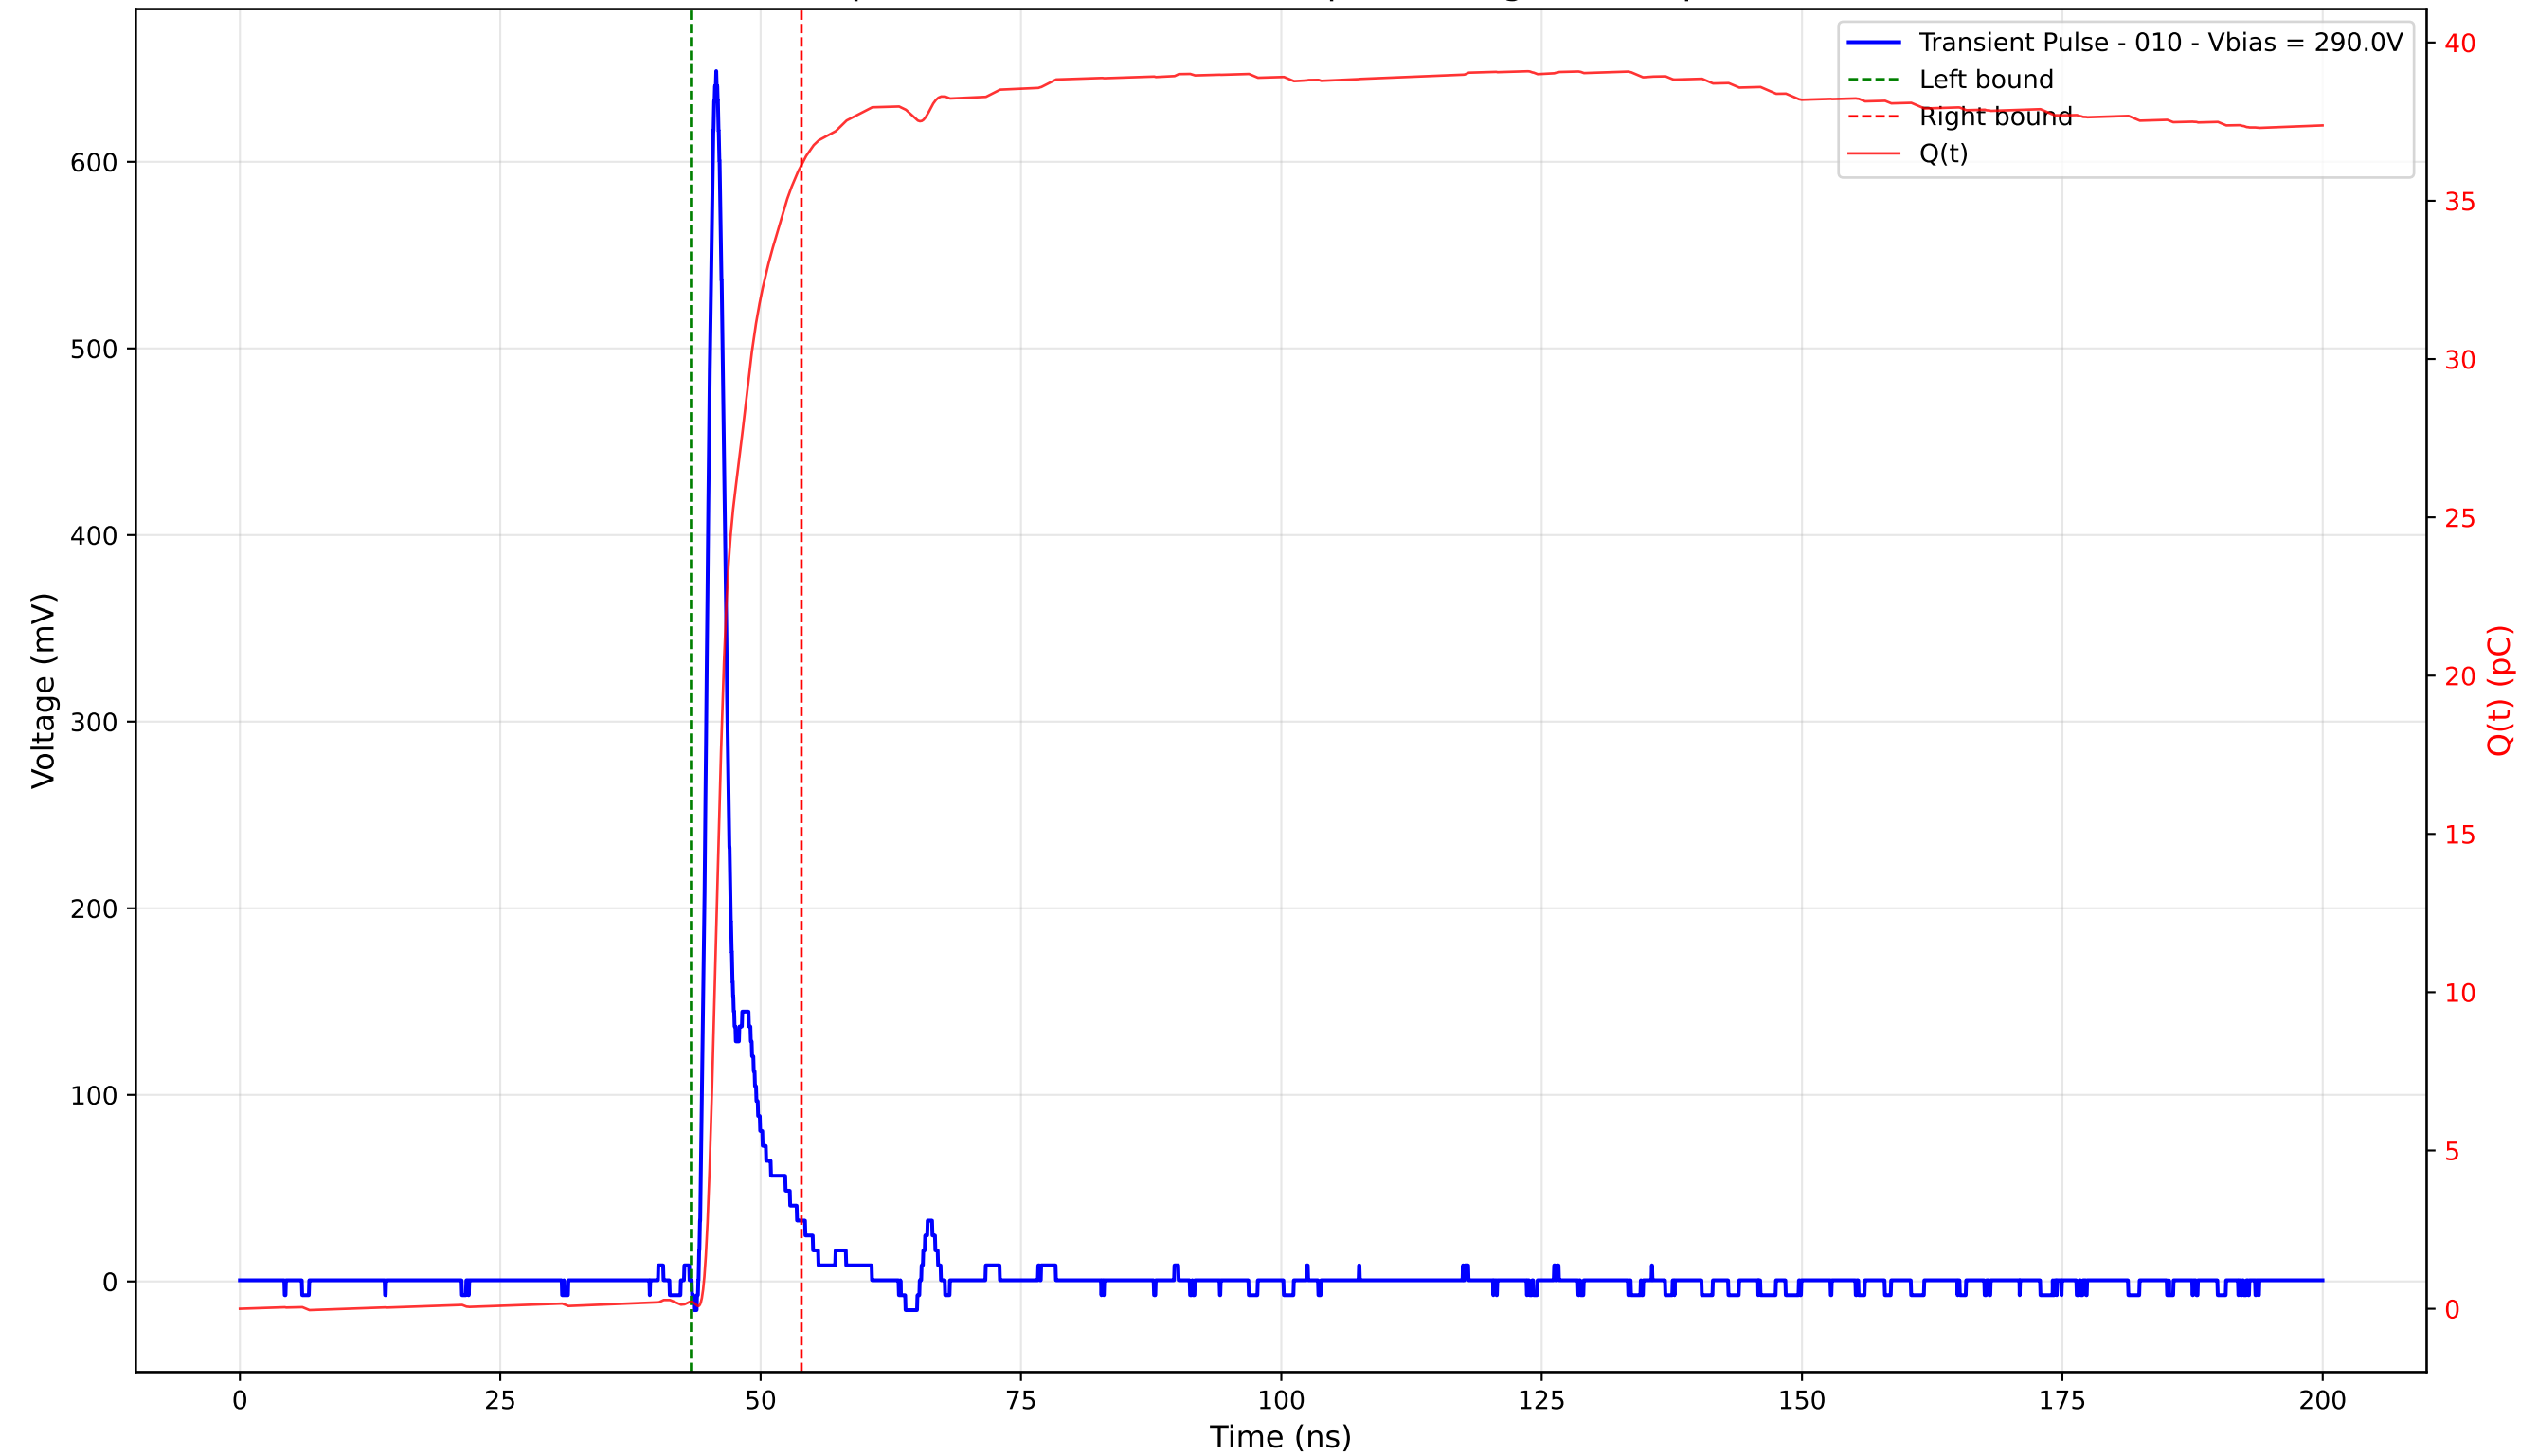


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 36.35 pC - Rise Time: 1.05 ns

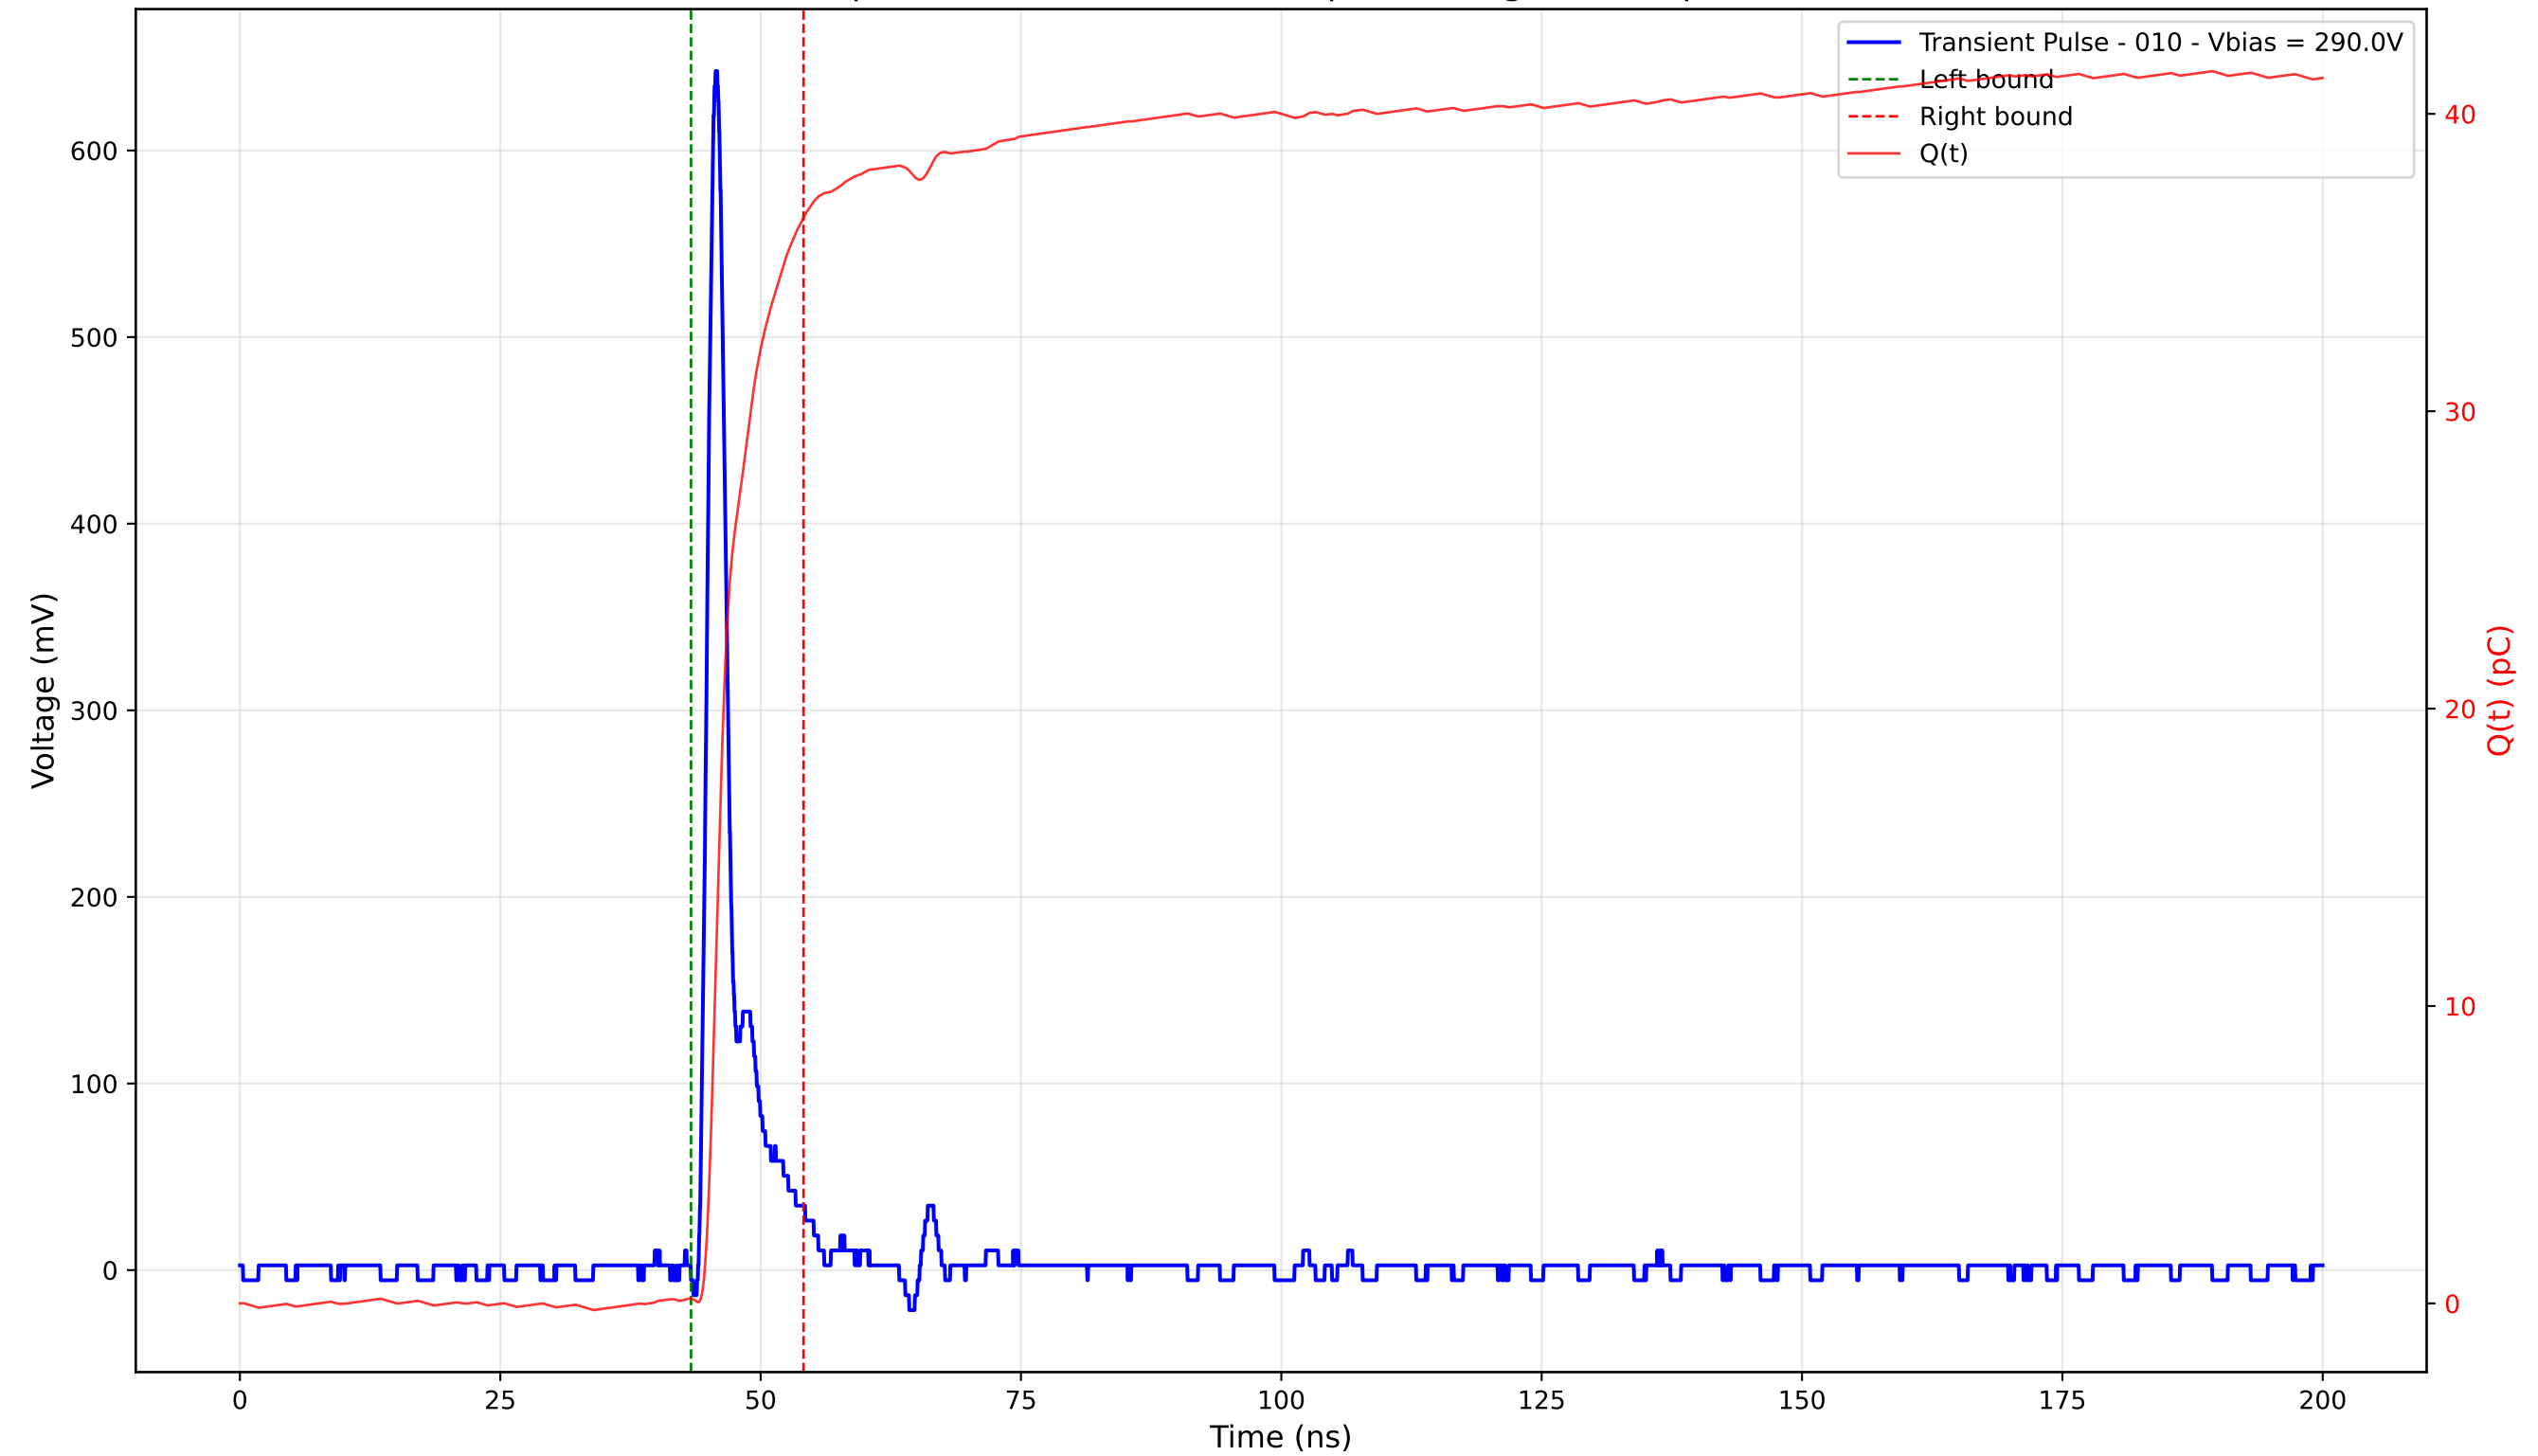


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 36.01 pC - Rise Time: 1.07 ns

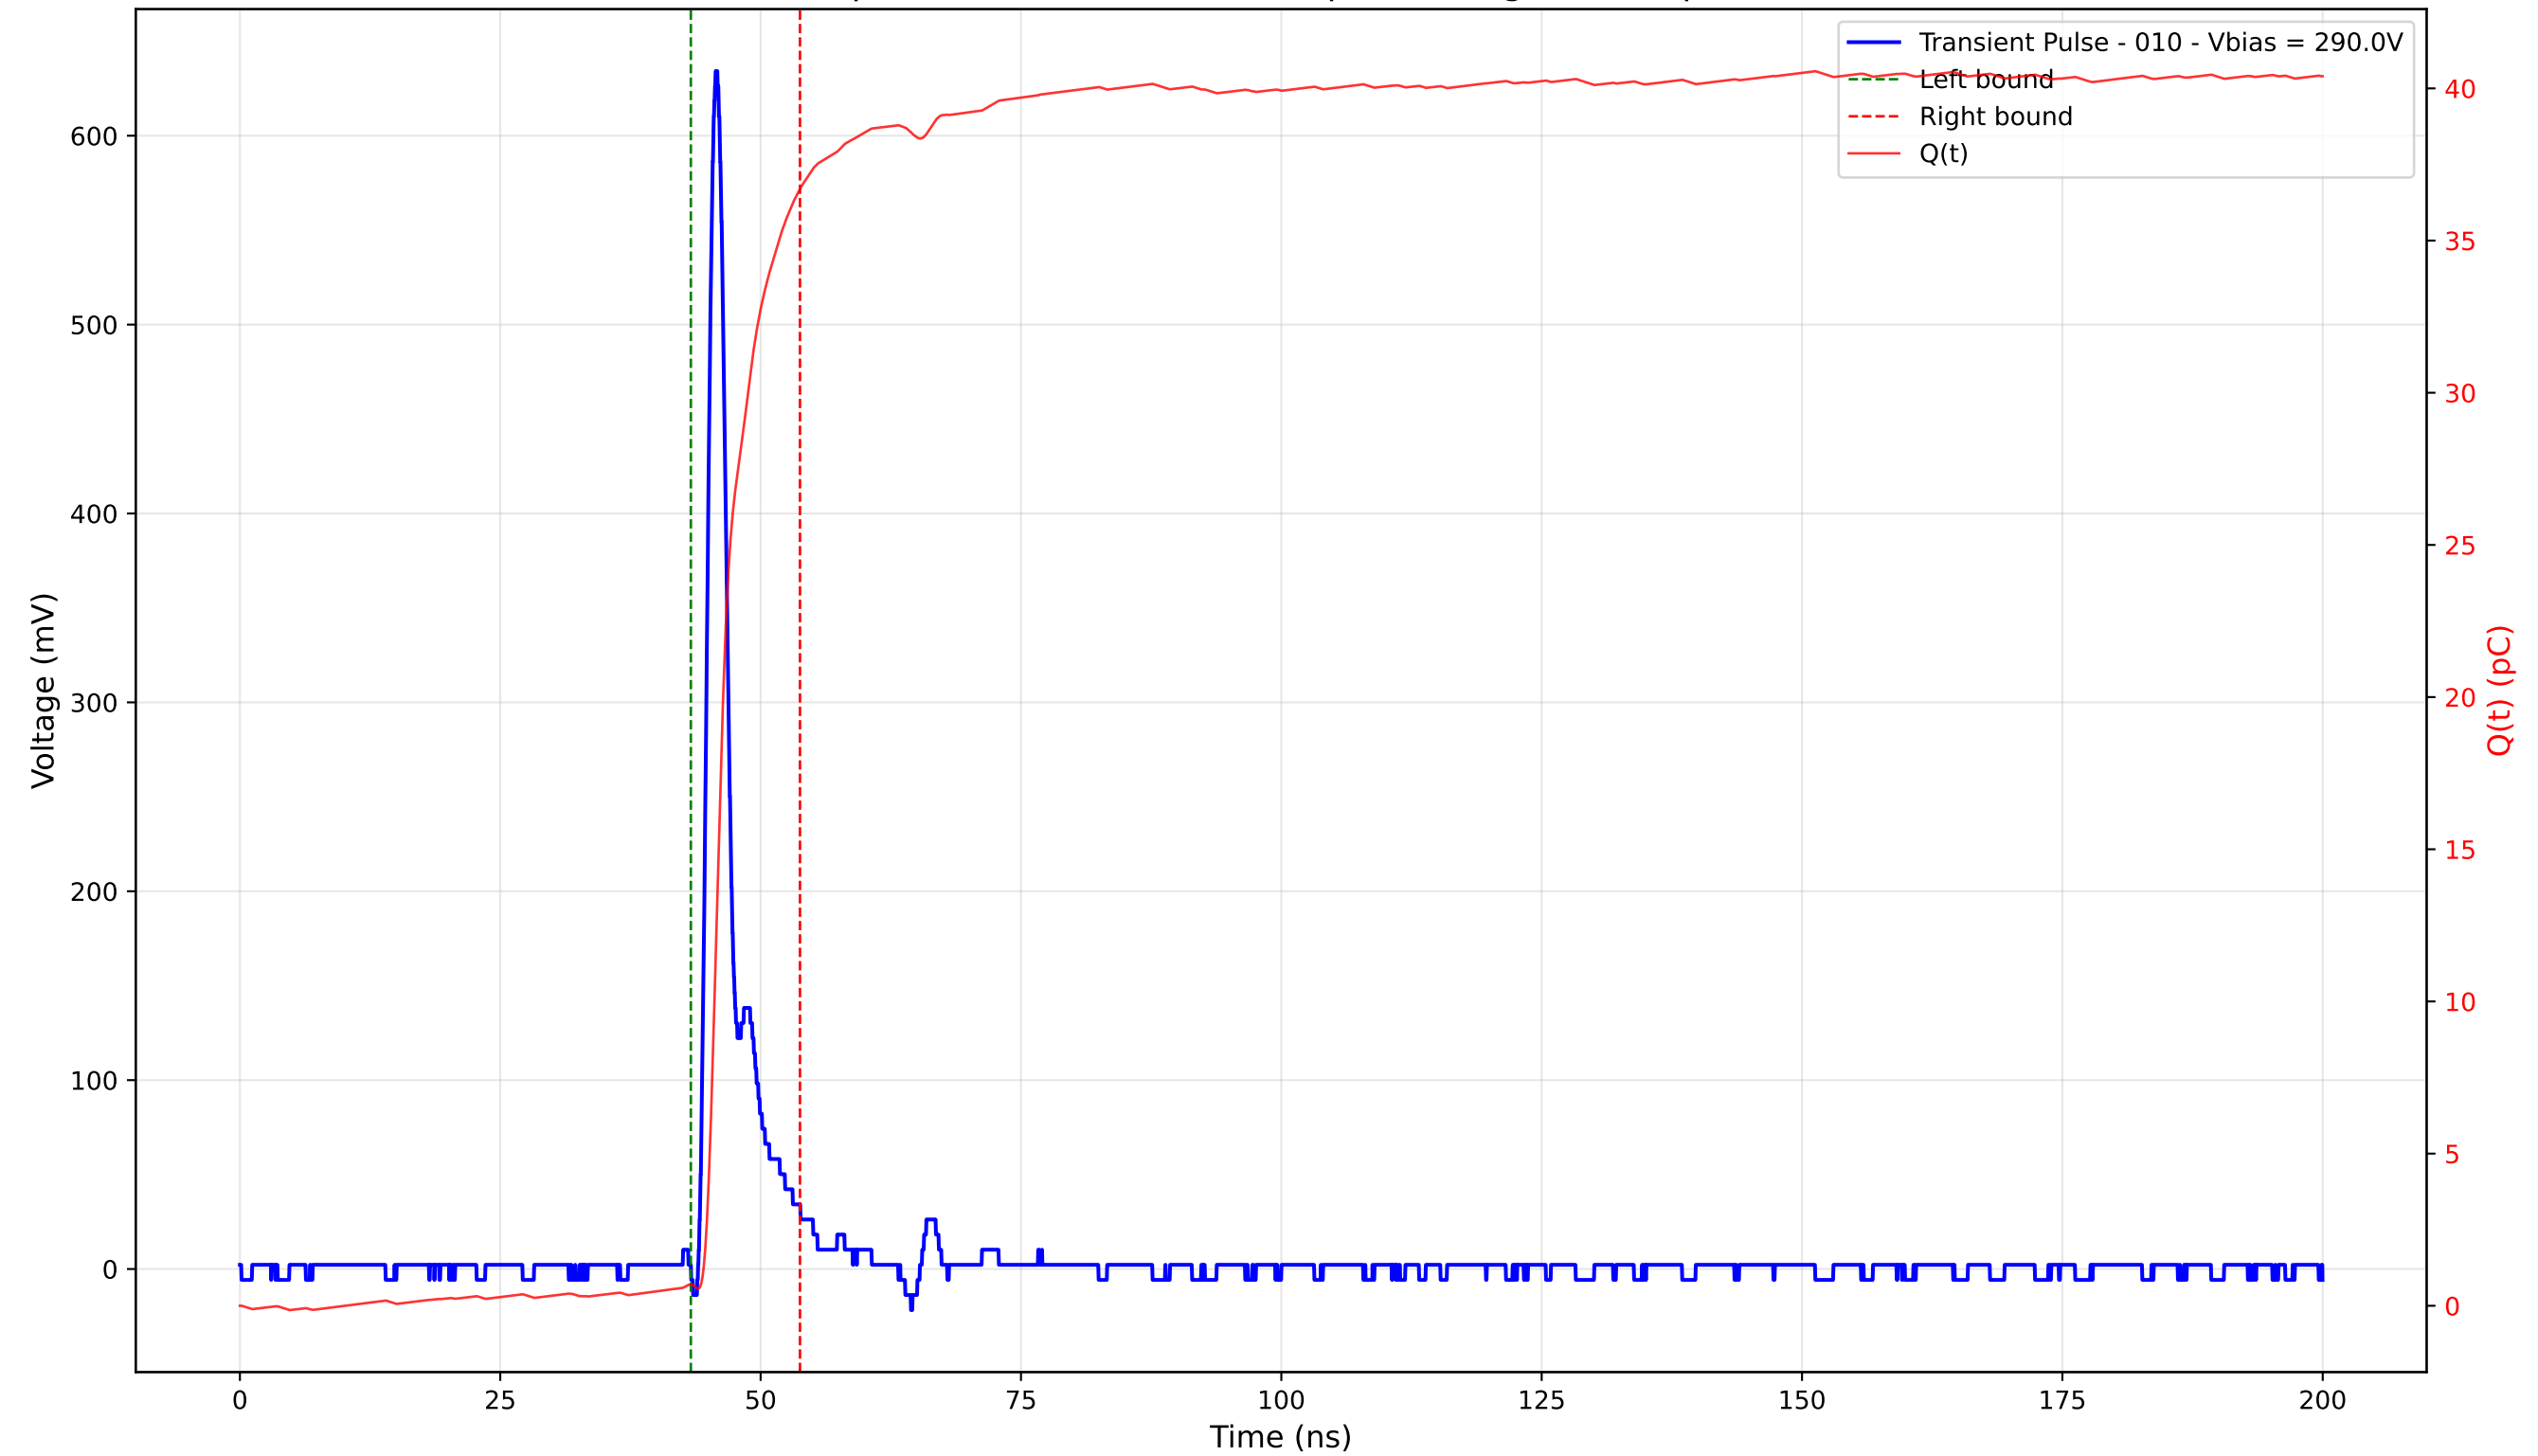


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 35.25 pC - Rise Time: 1.09 ns

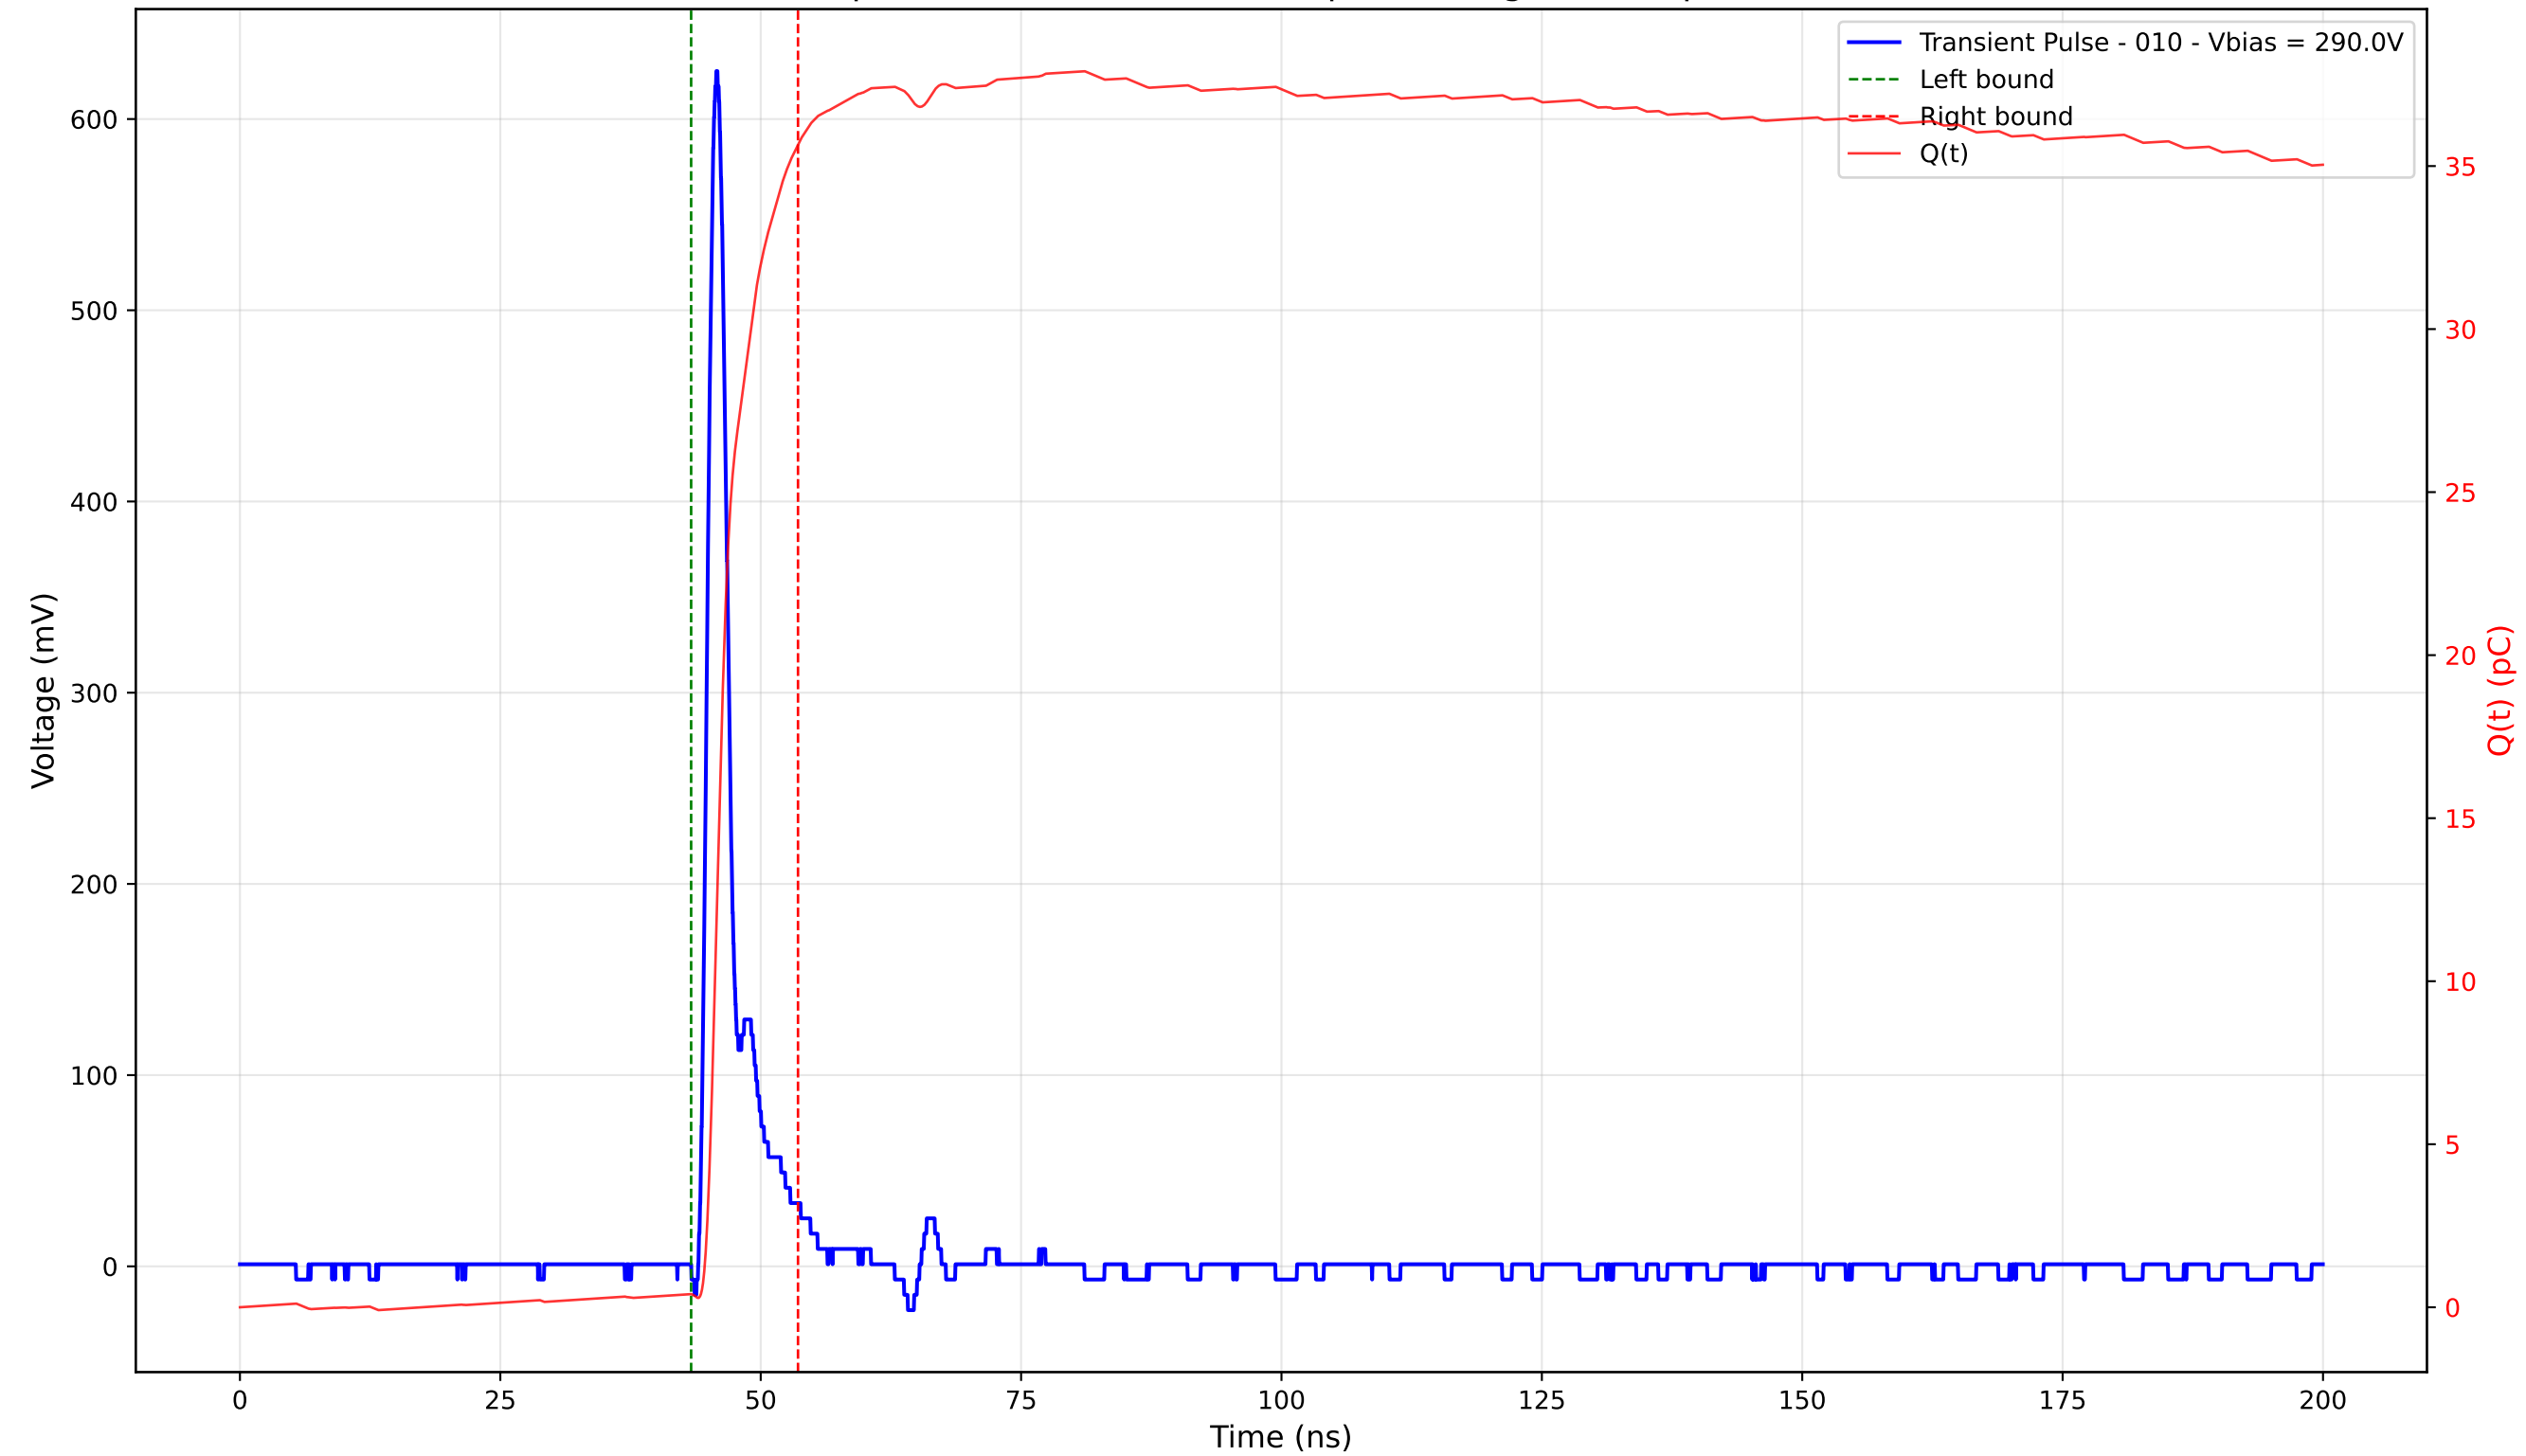


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 35.32 pC - Rise Time: 1.08 ns

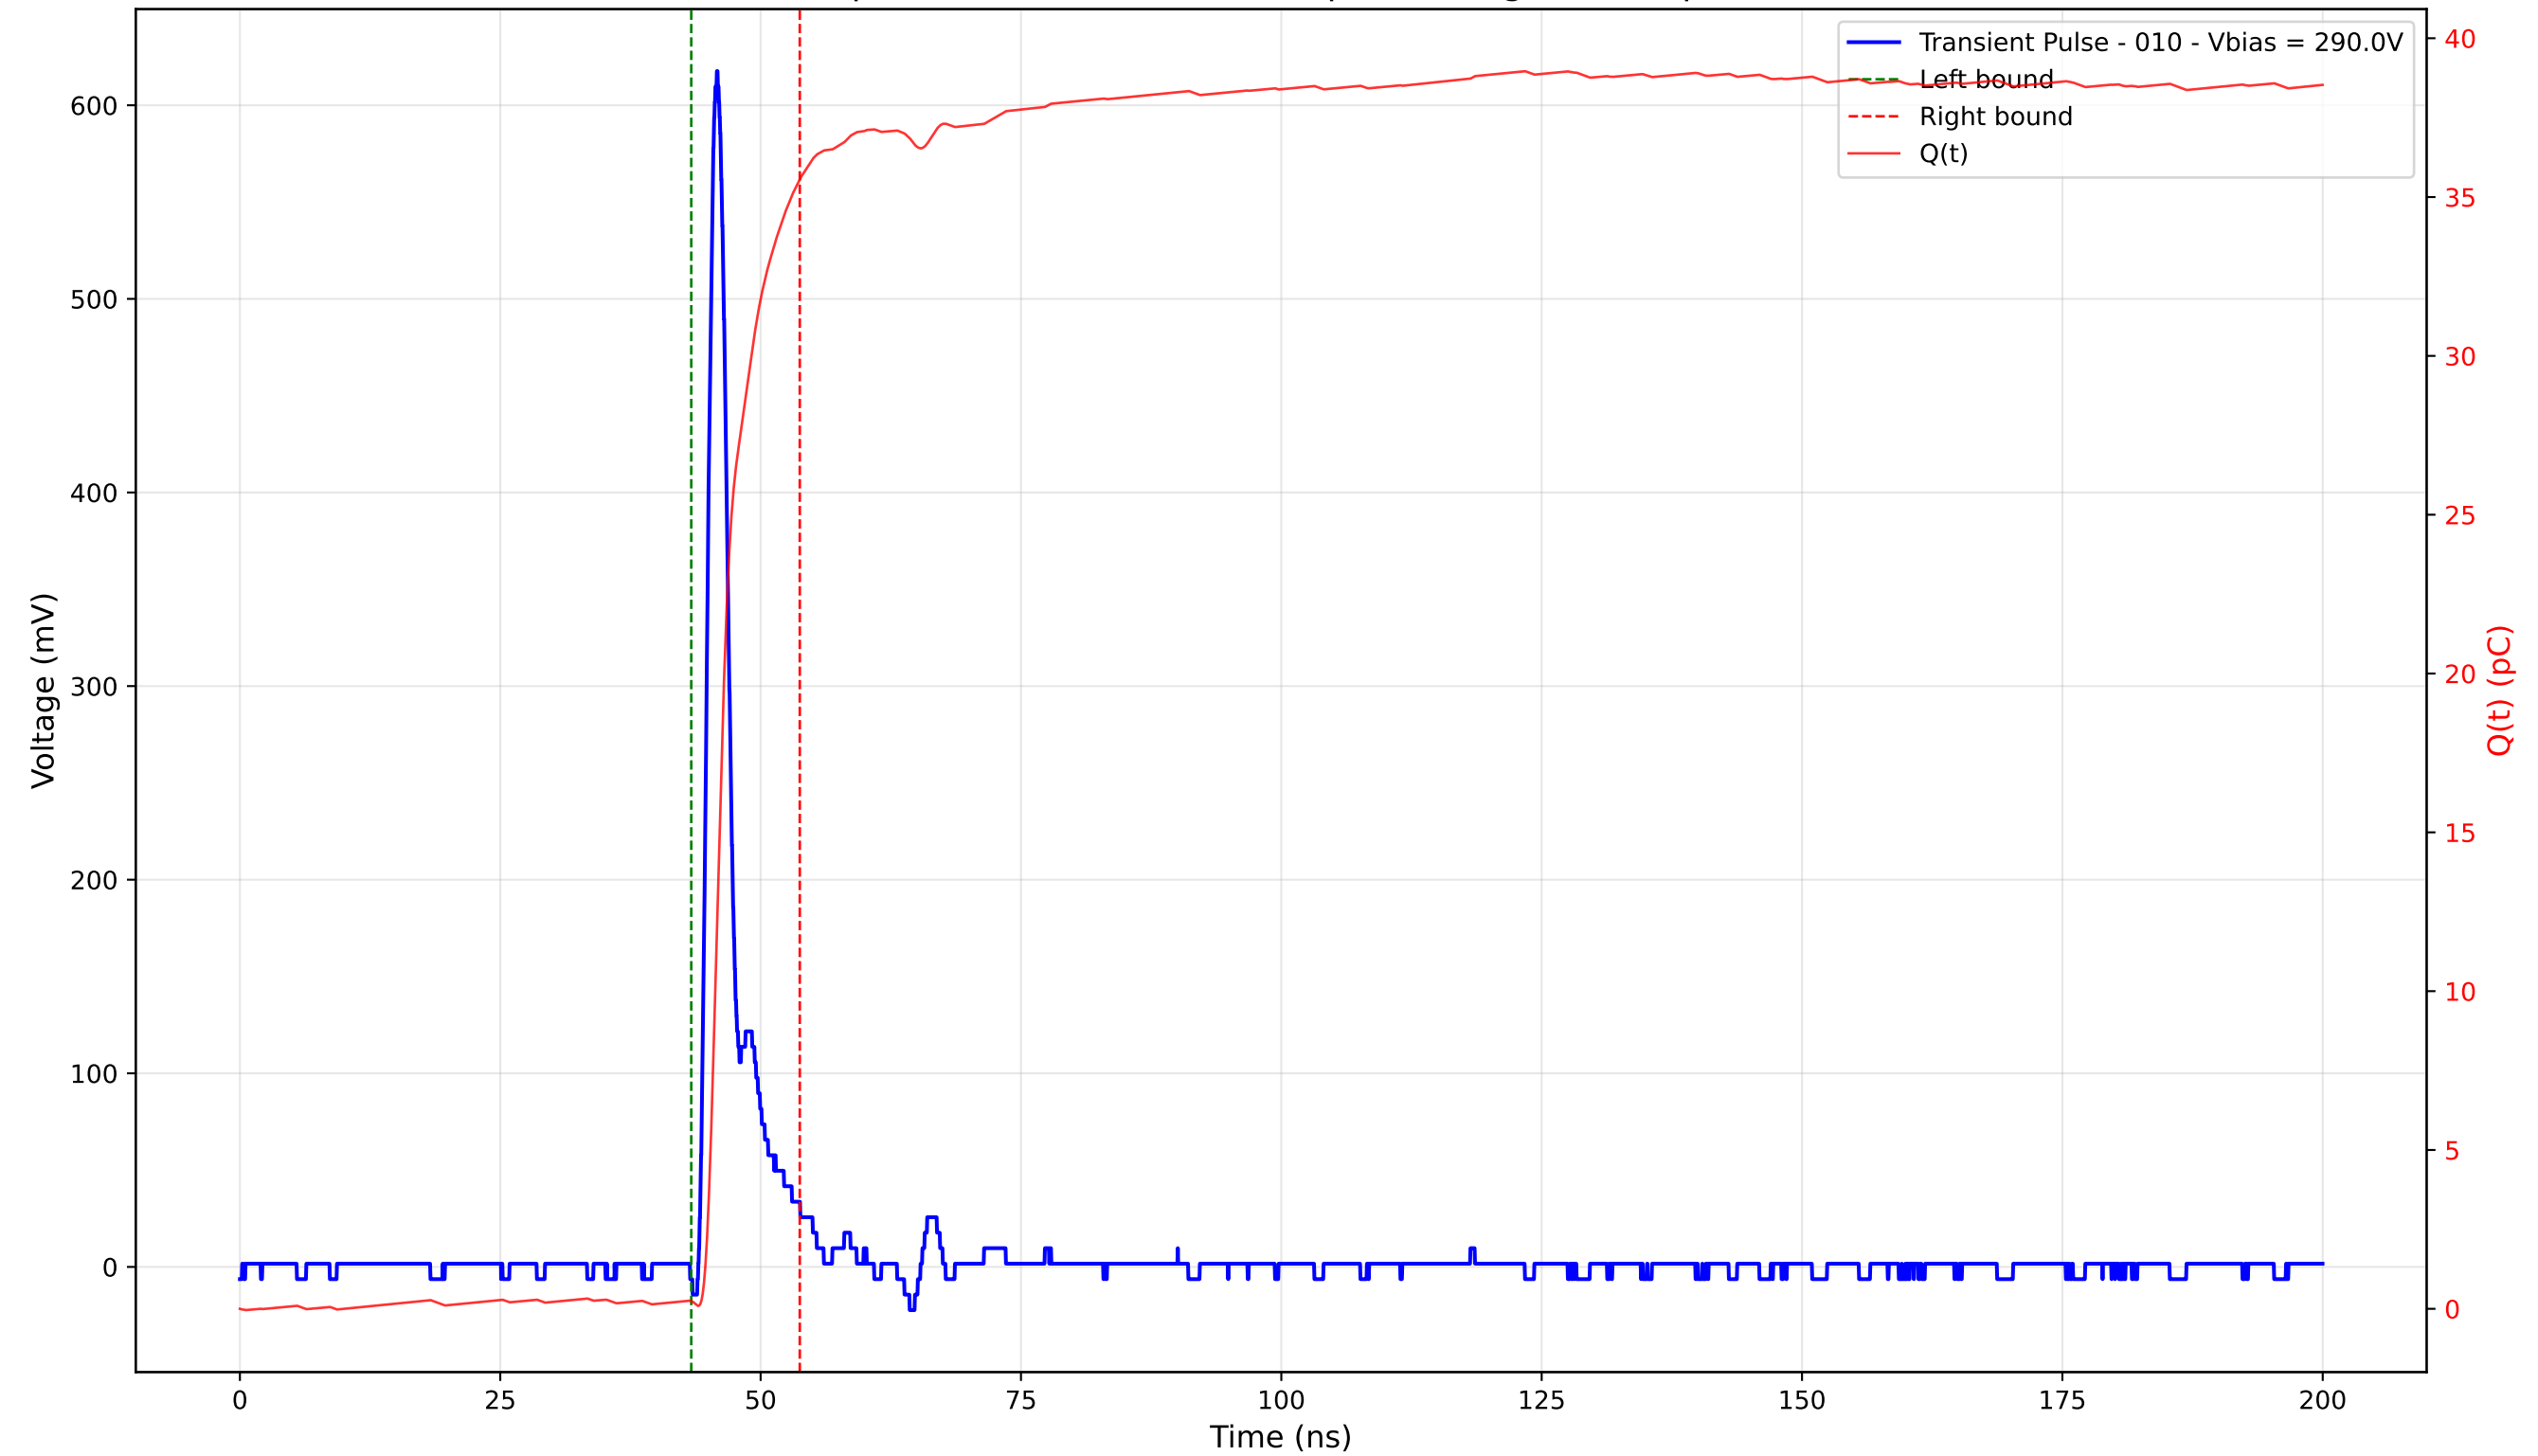


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 35.07 pC - Rise Time: 1.06 ns

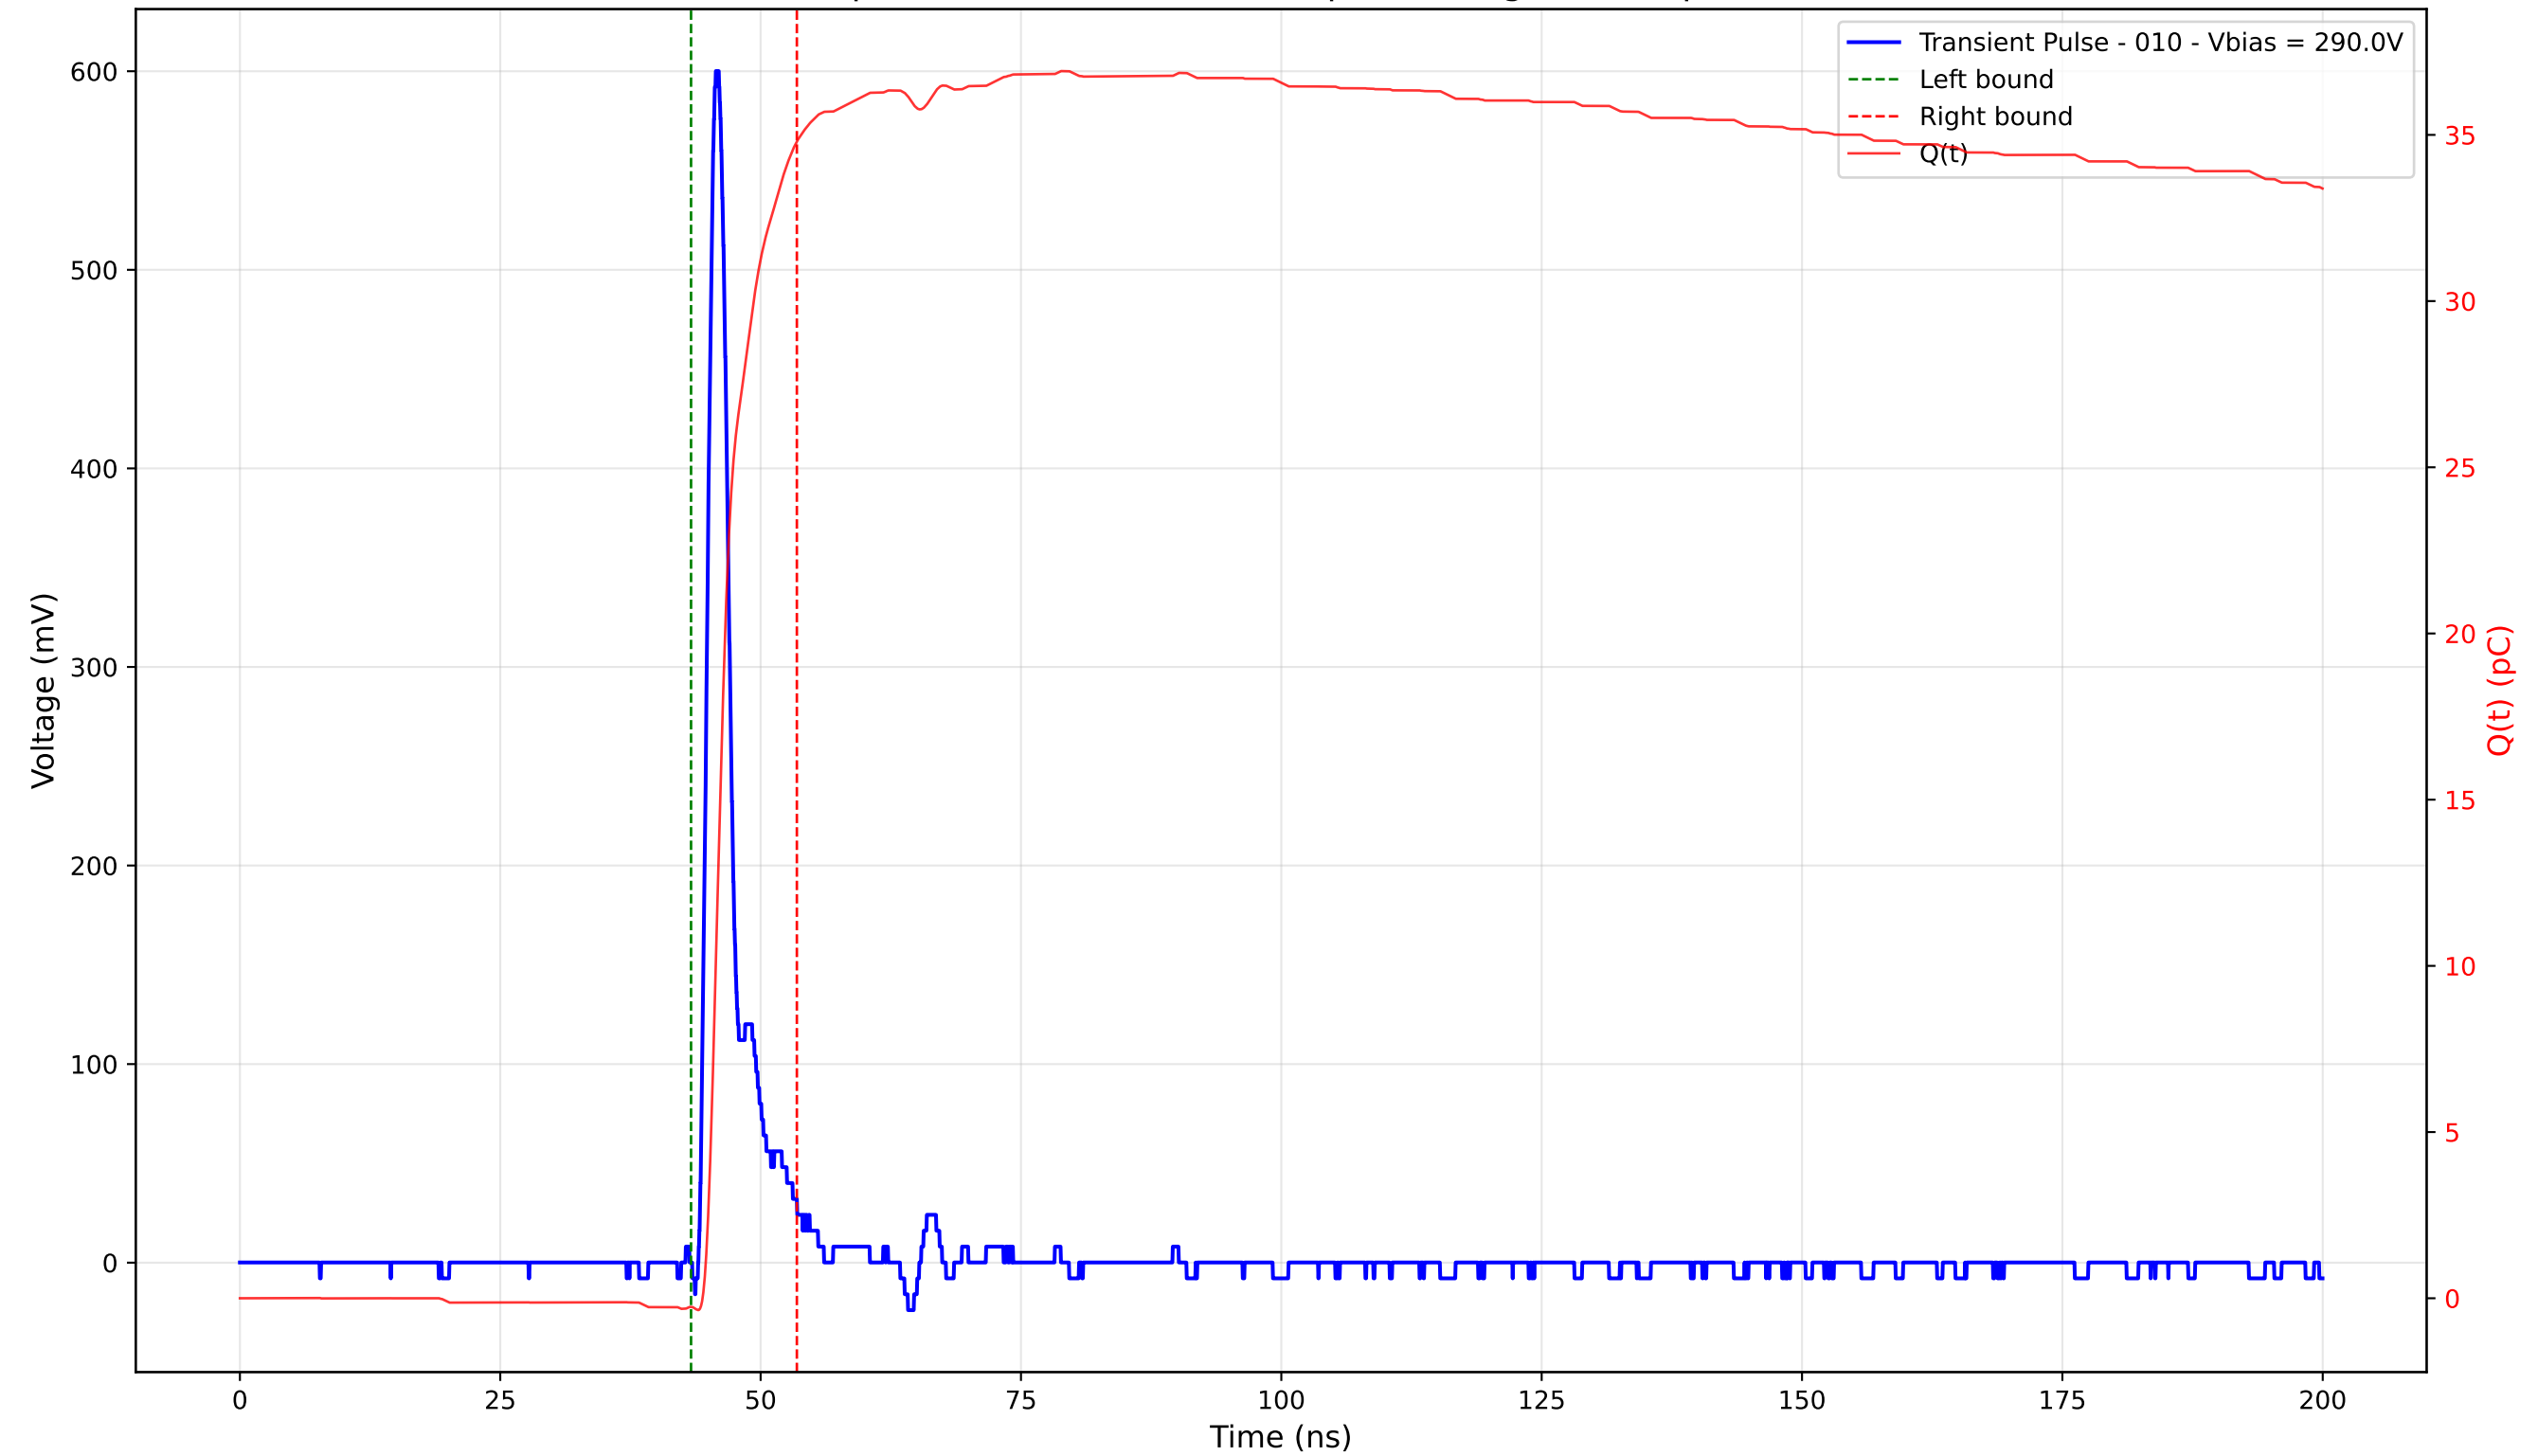


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 35.35 pC - Rise Time: 1.10 ns

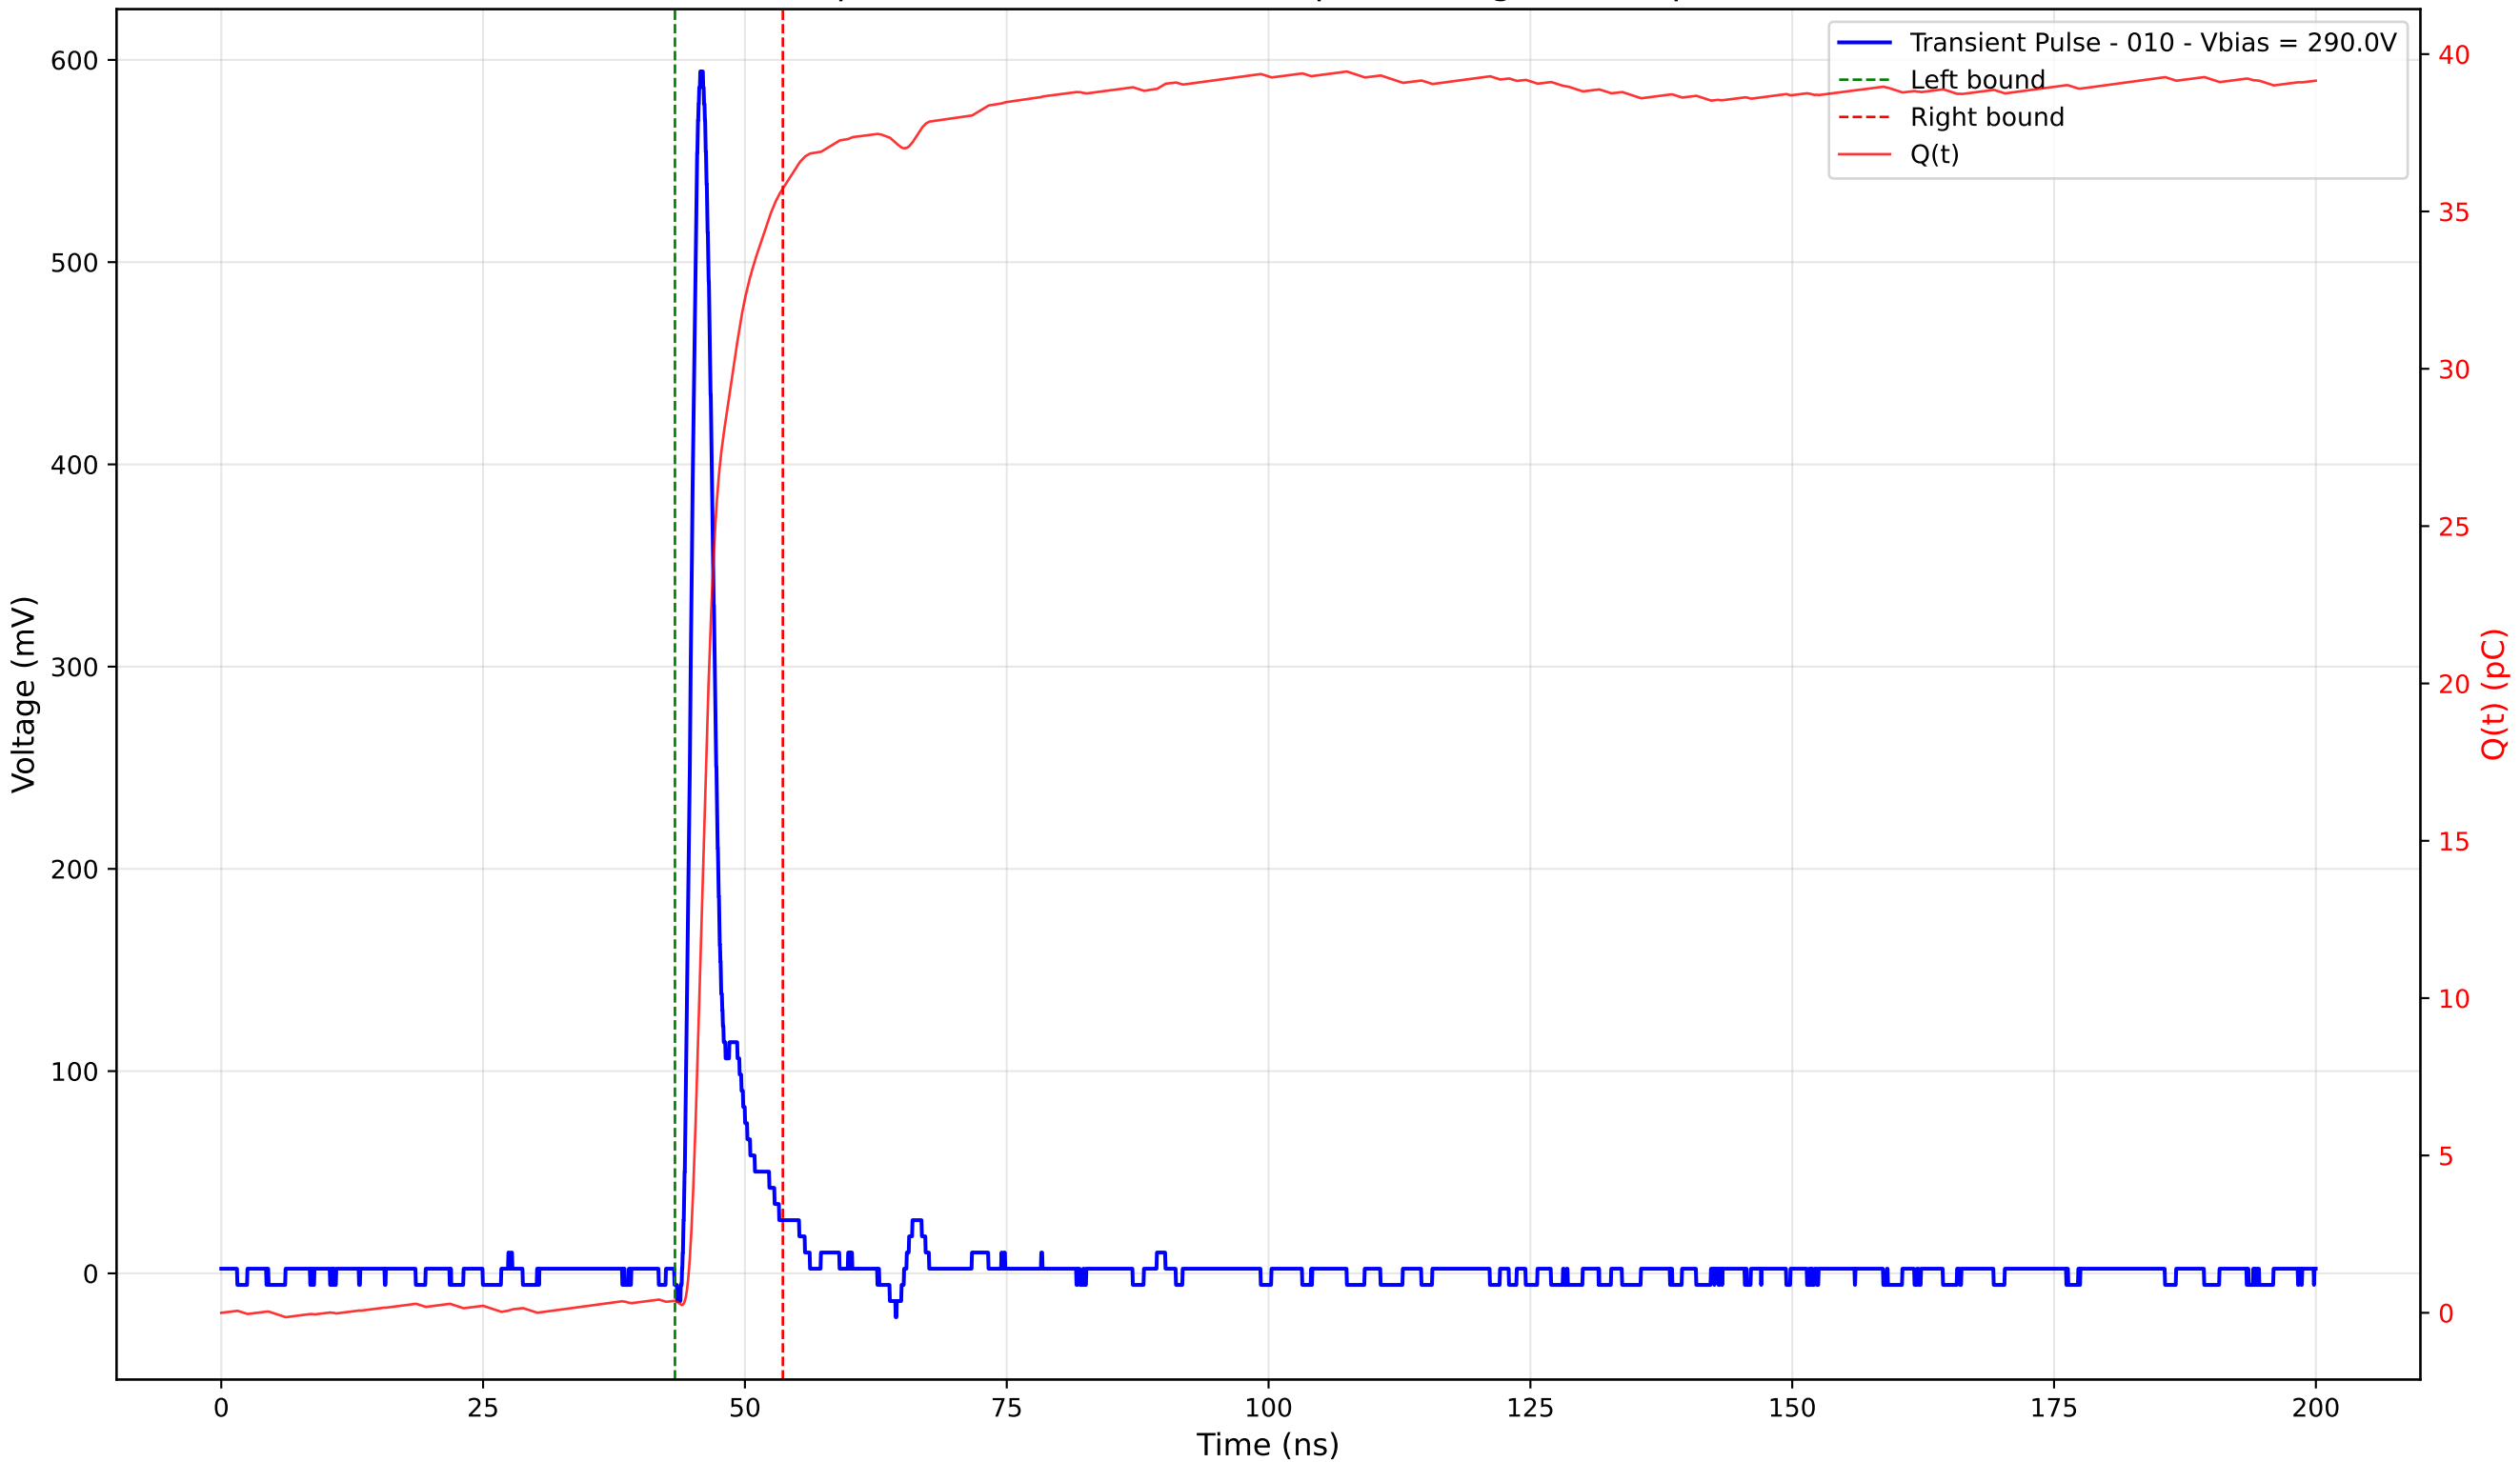


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 35.26 pC - Rise Time: 1.08 ns

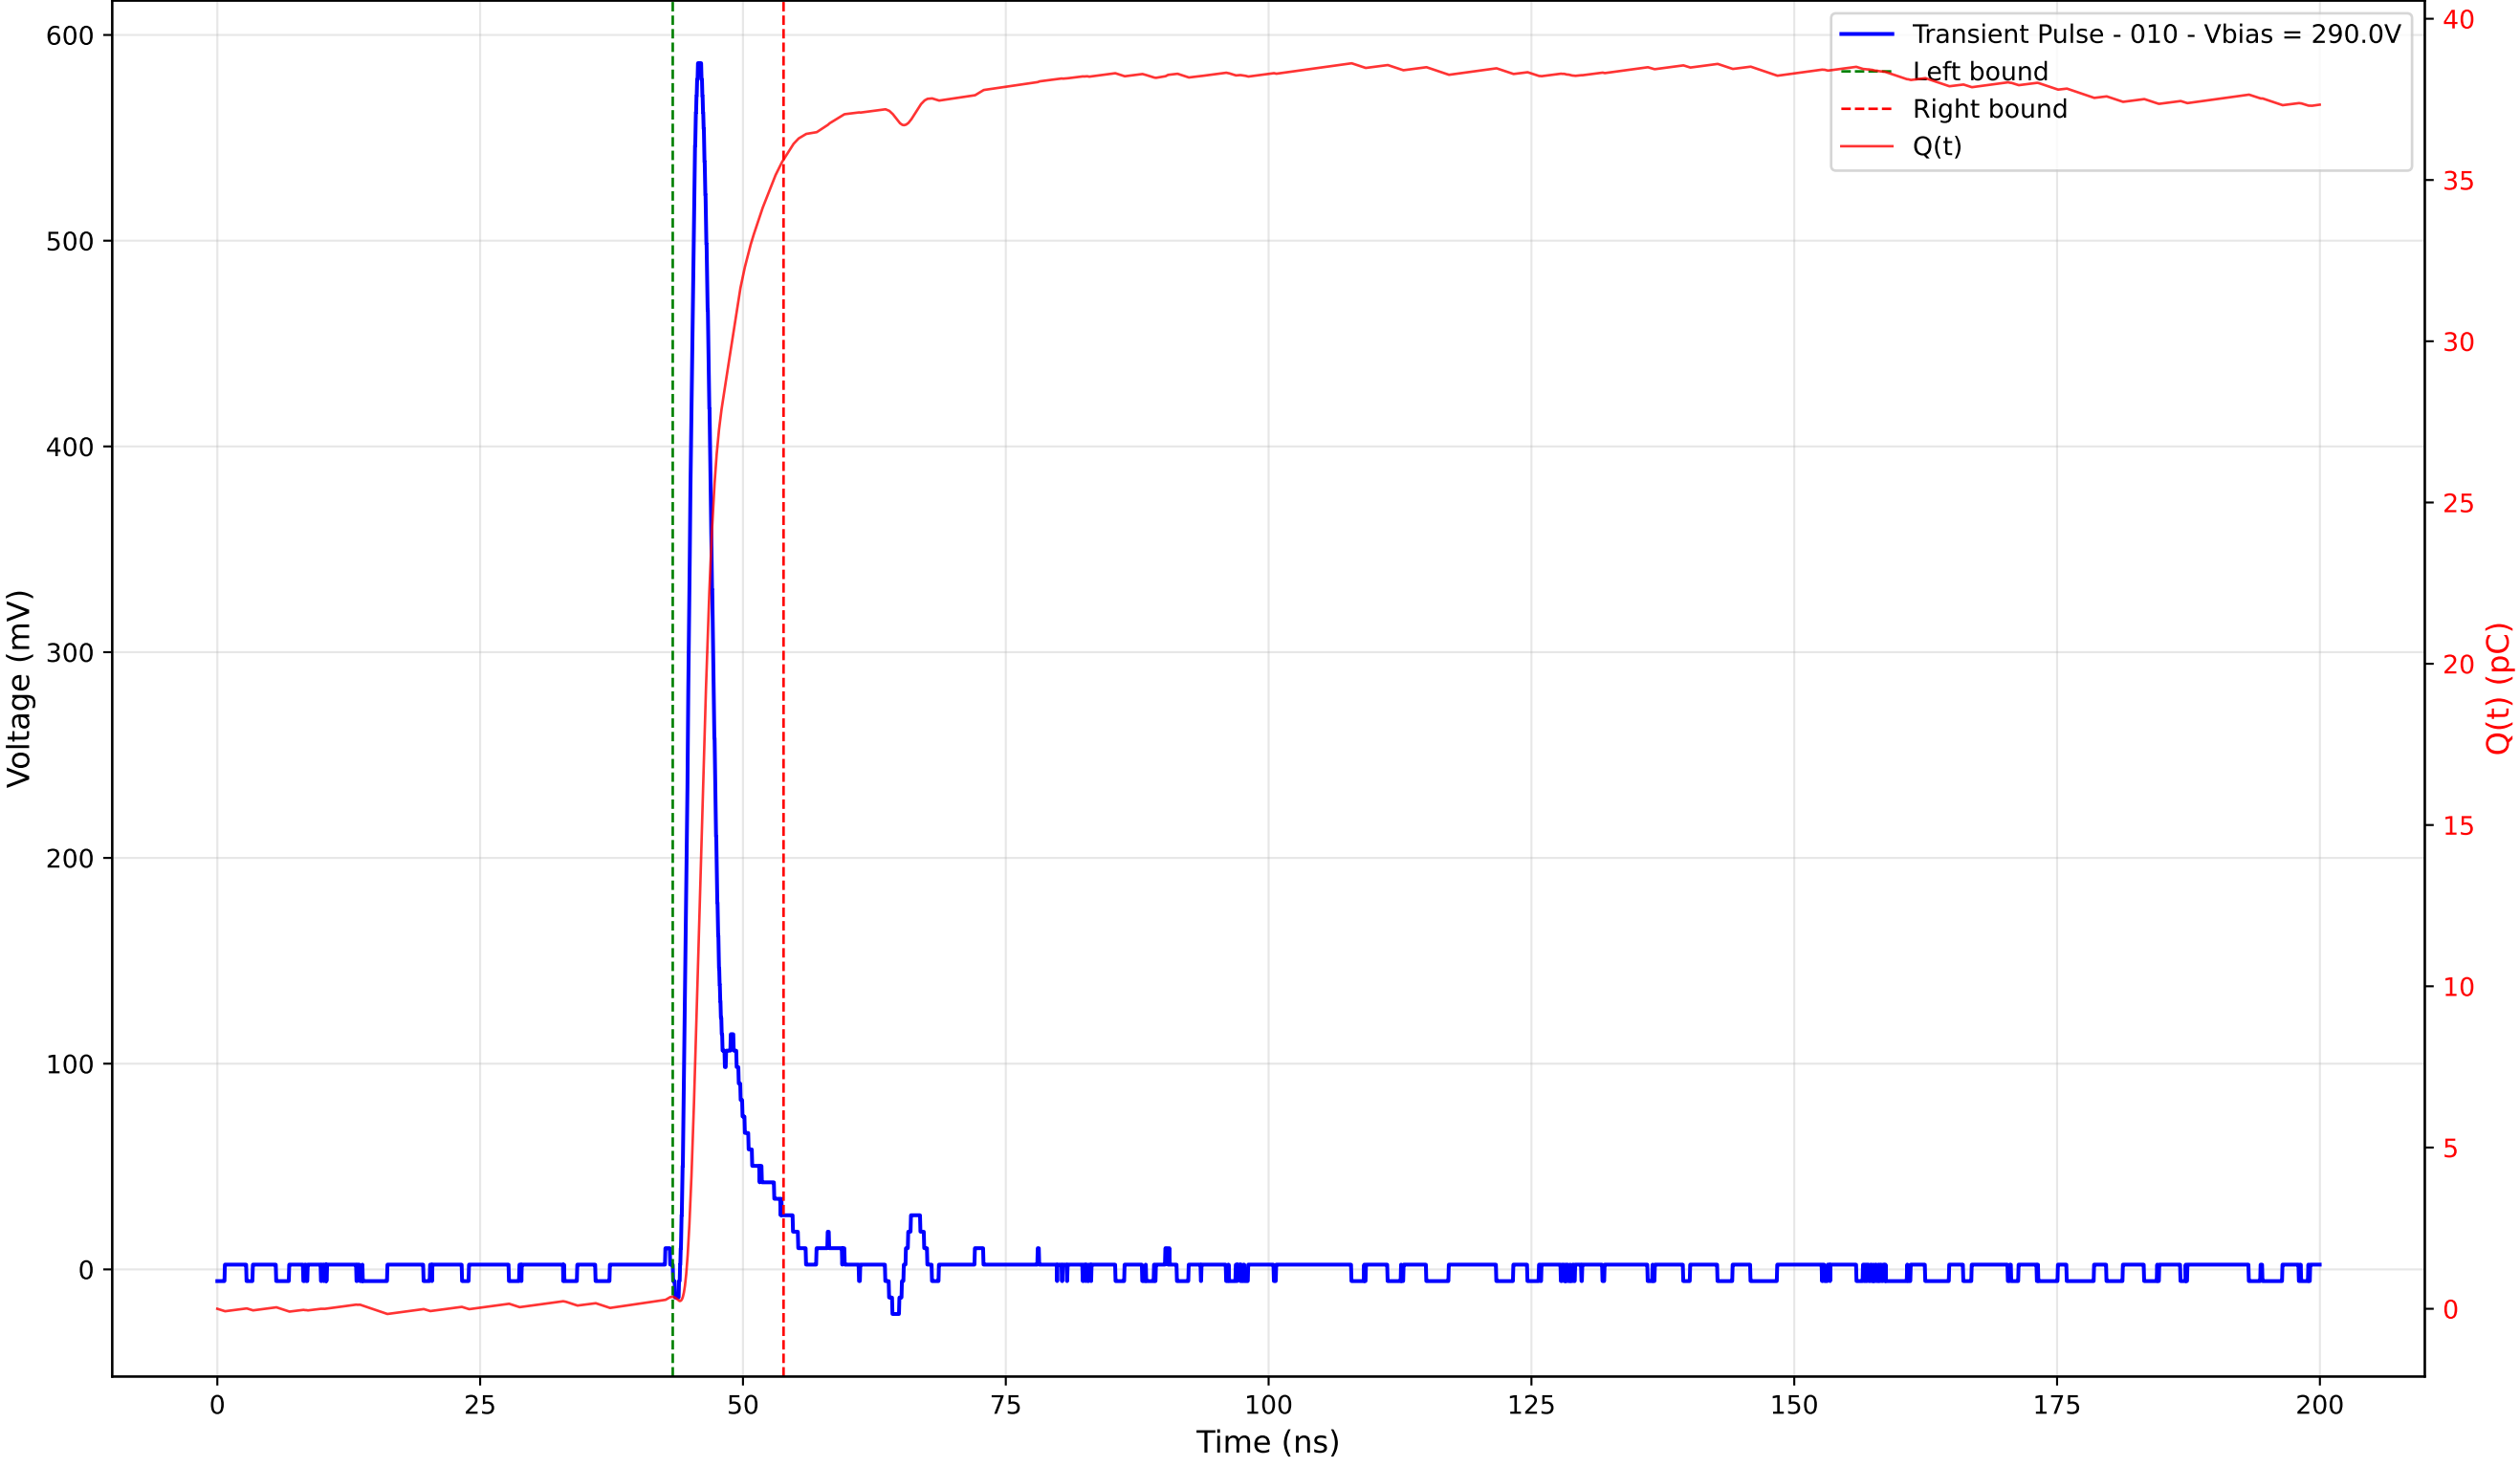


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 34.85 pC - Rise Time: 1.10 ns

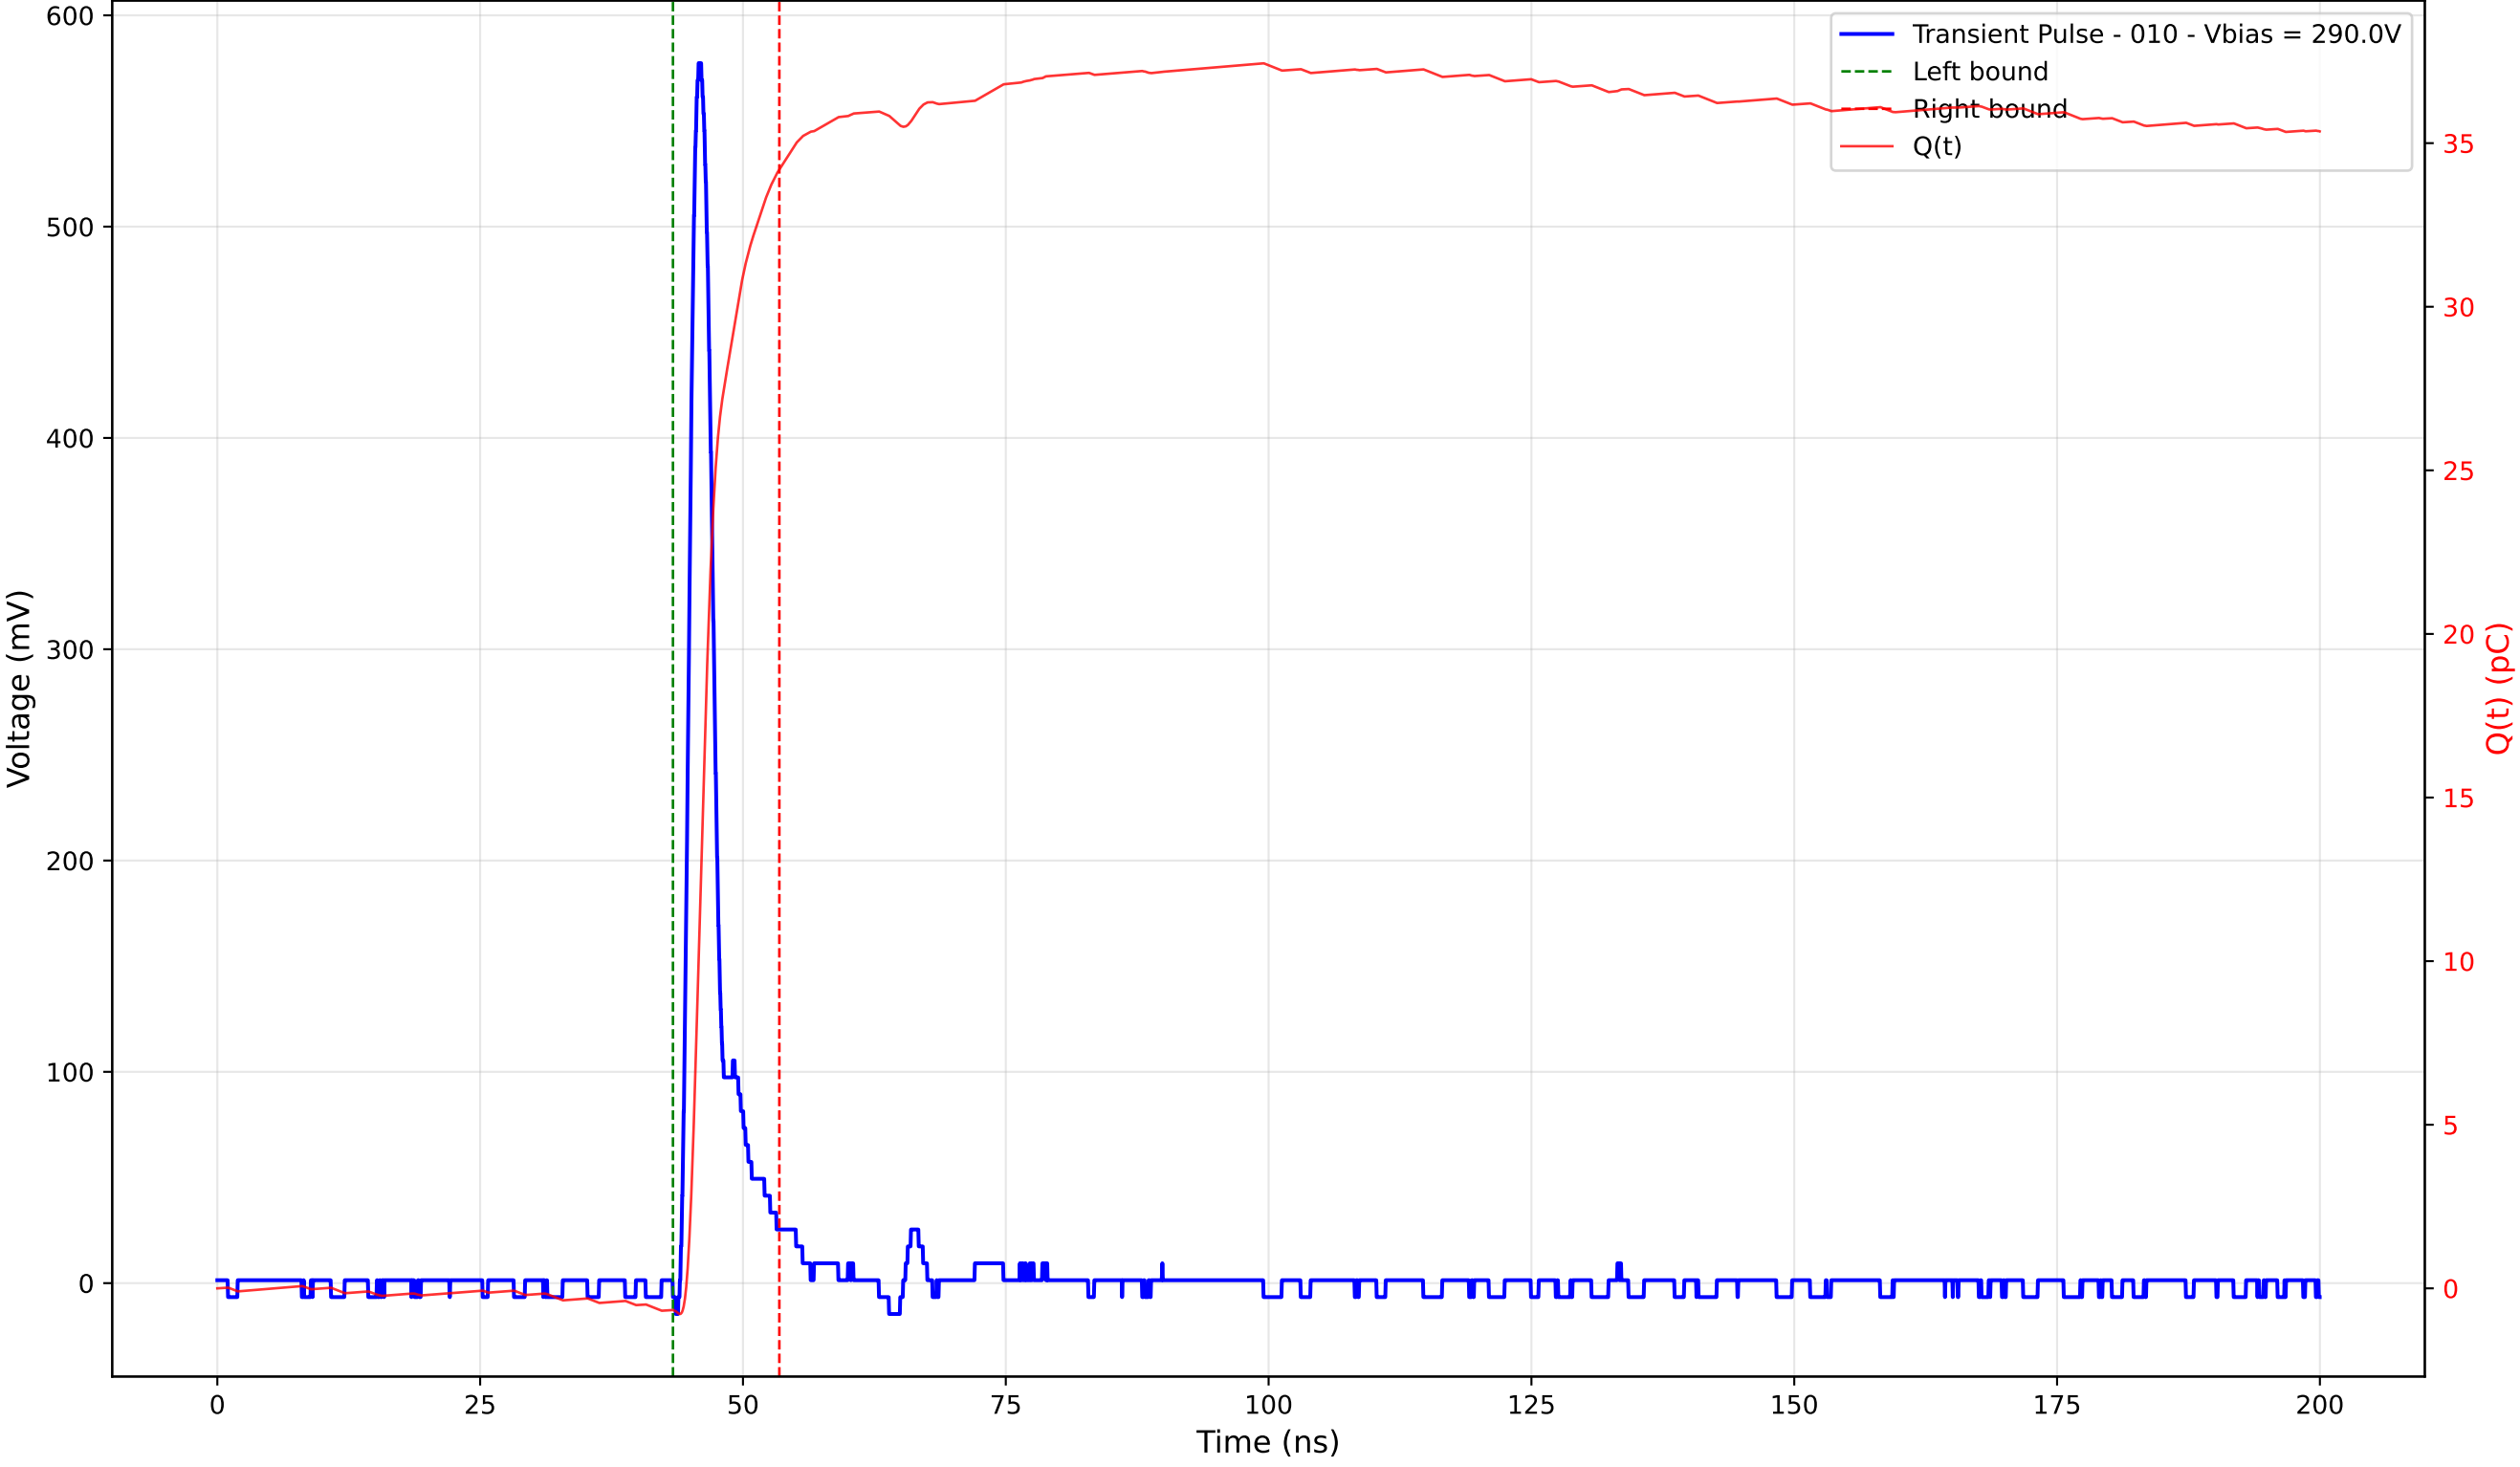


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 34.90 pC - Rise Time: 1.10 ns

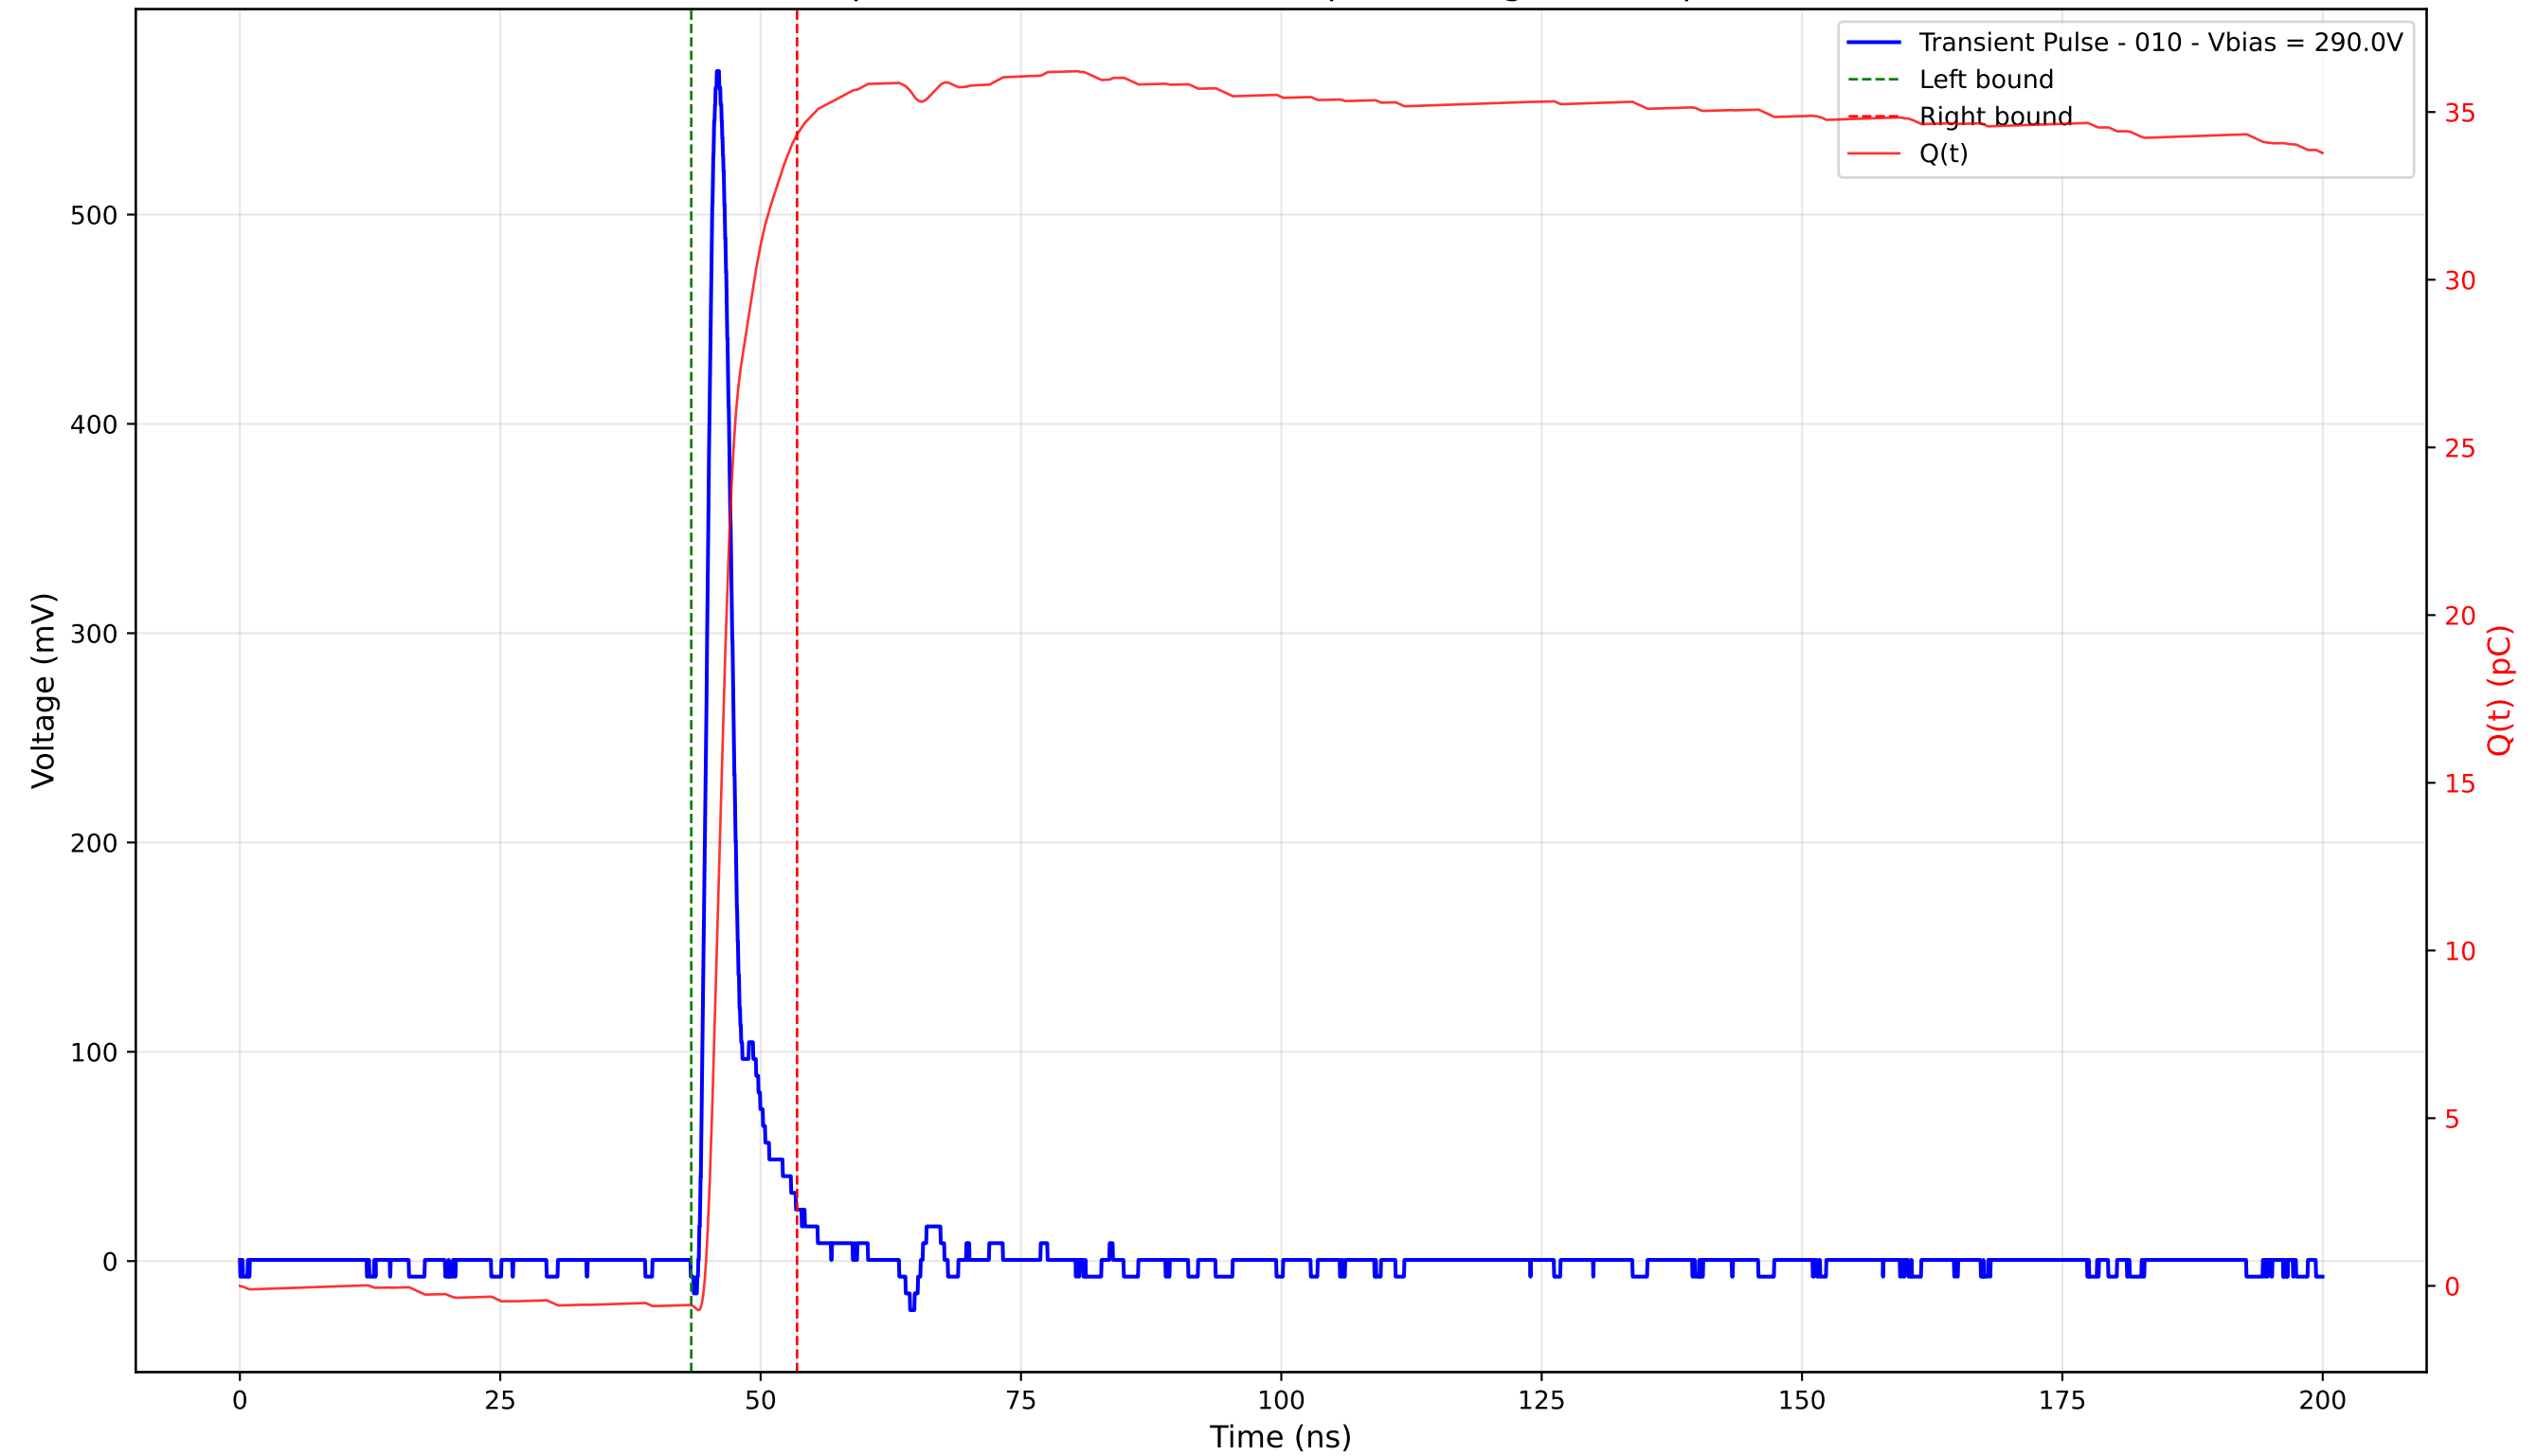


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 35.29 pC - Rise Time: 1.06 ns

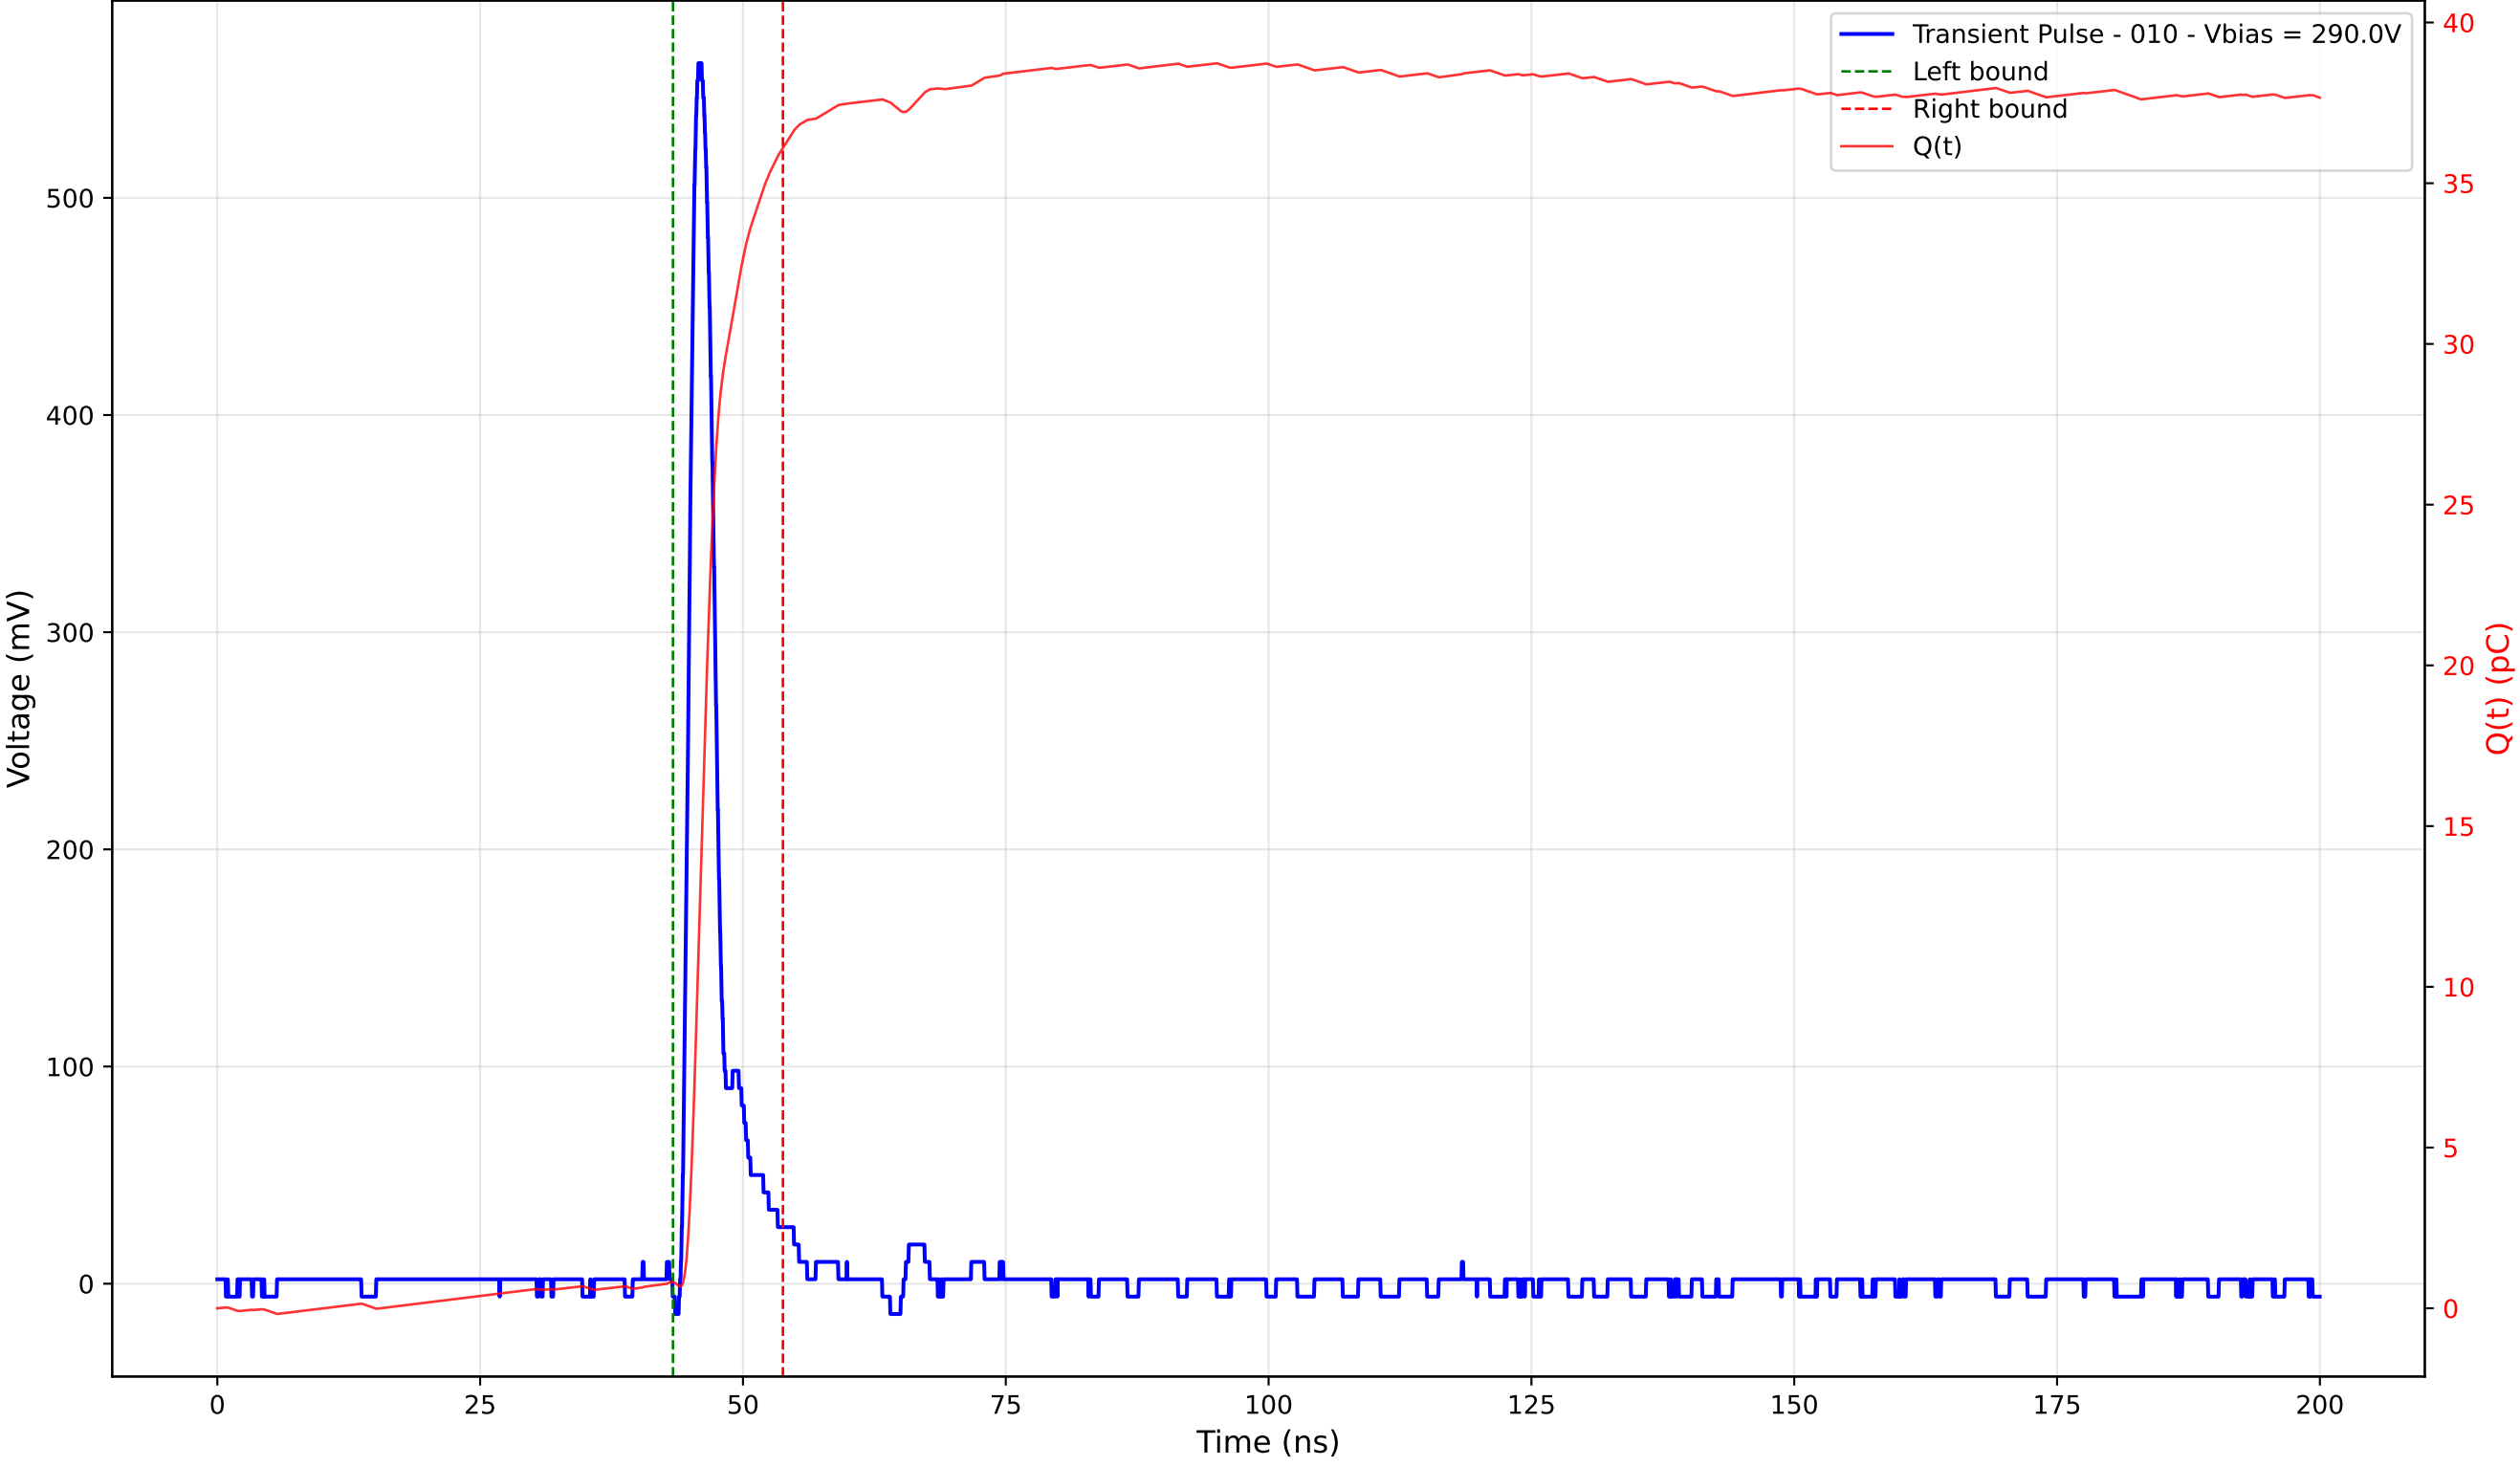


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 35.29 pC - Rise Time: 1.11 ns

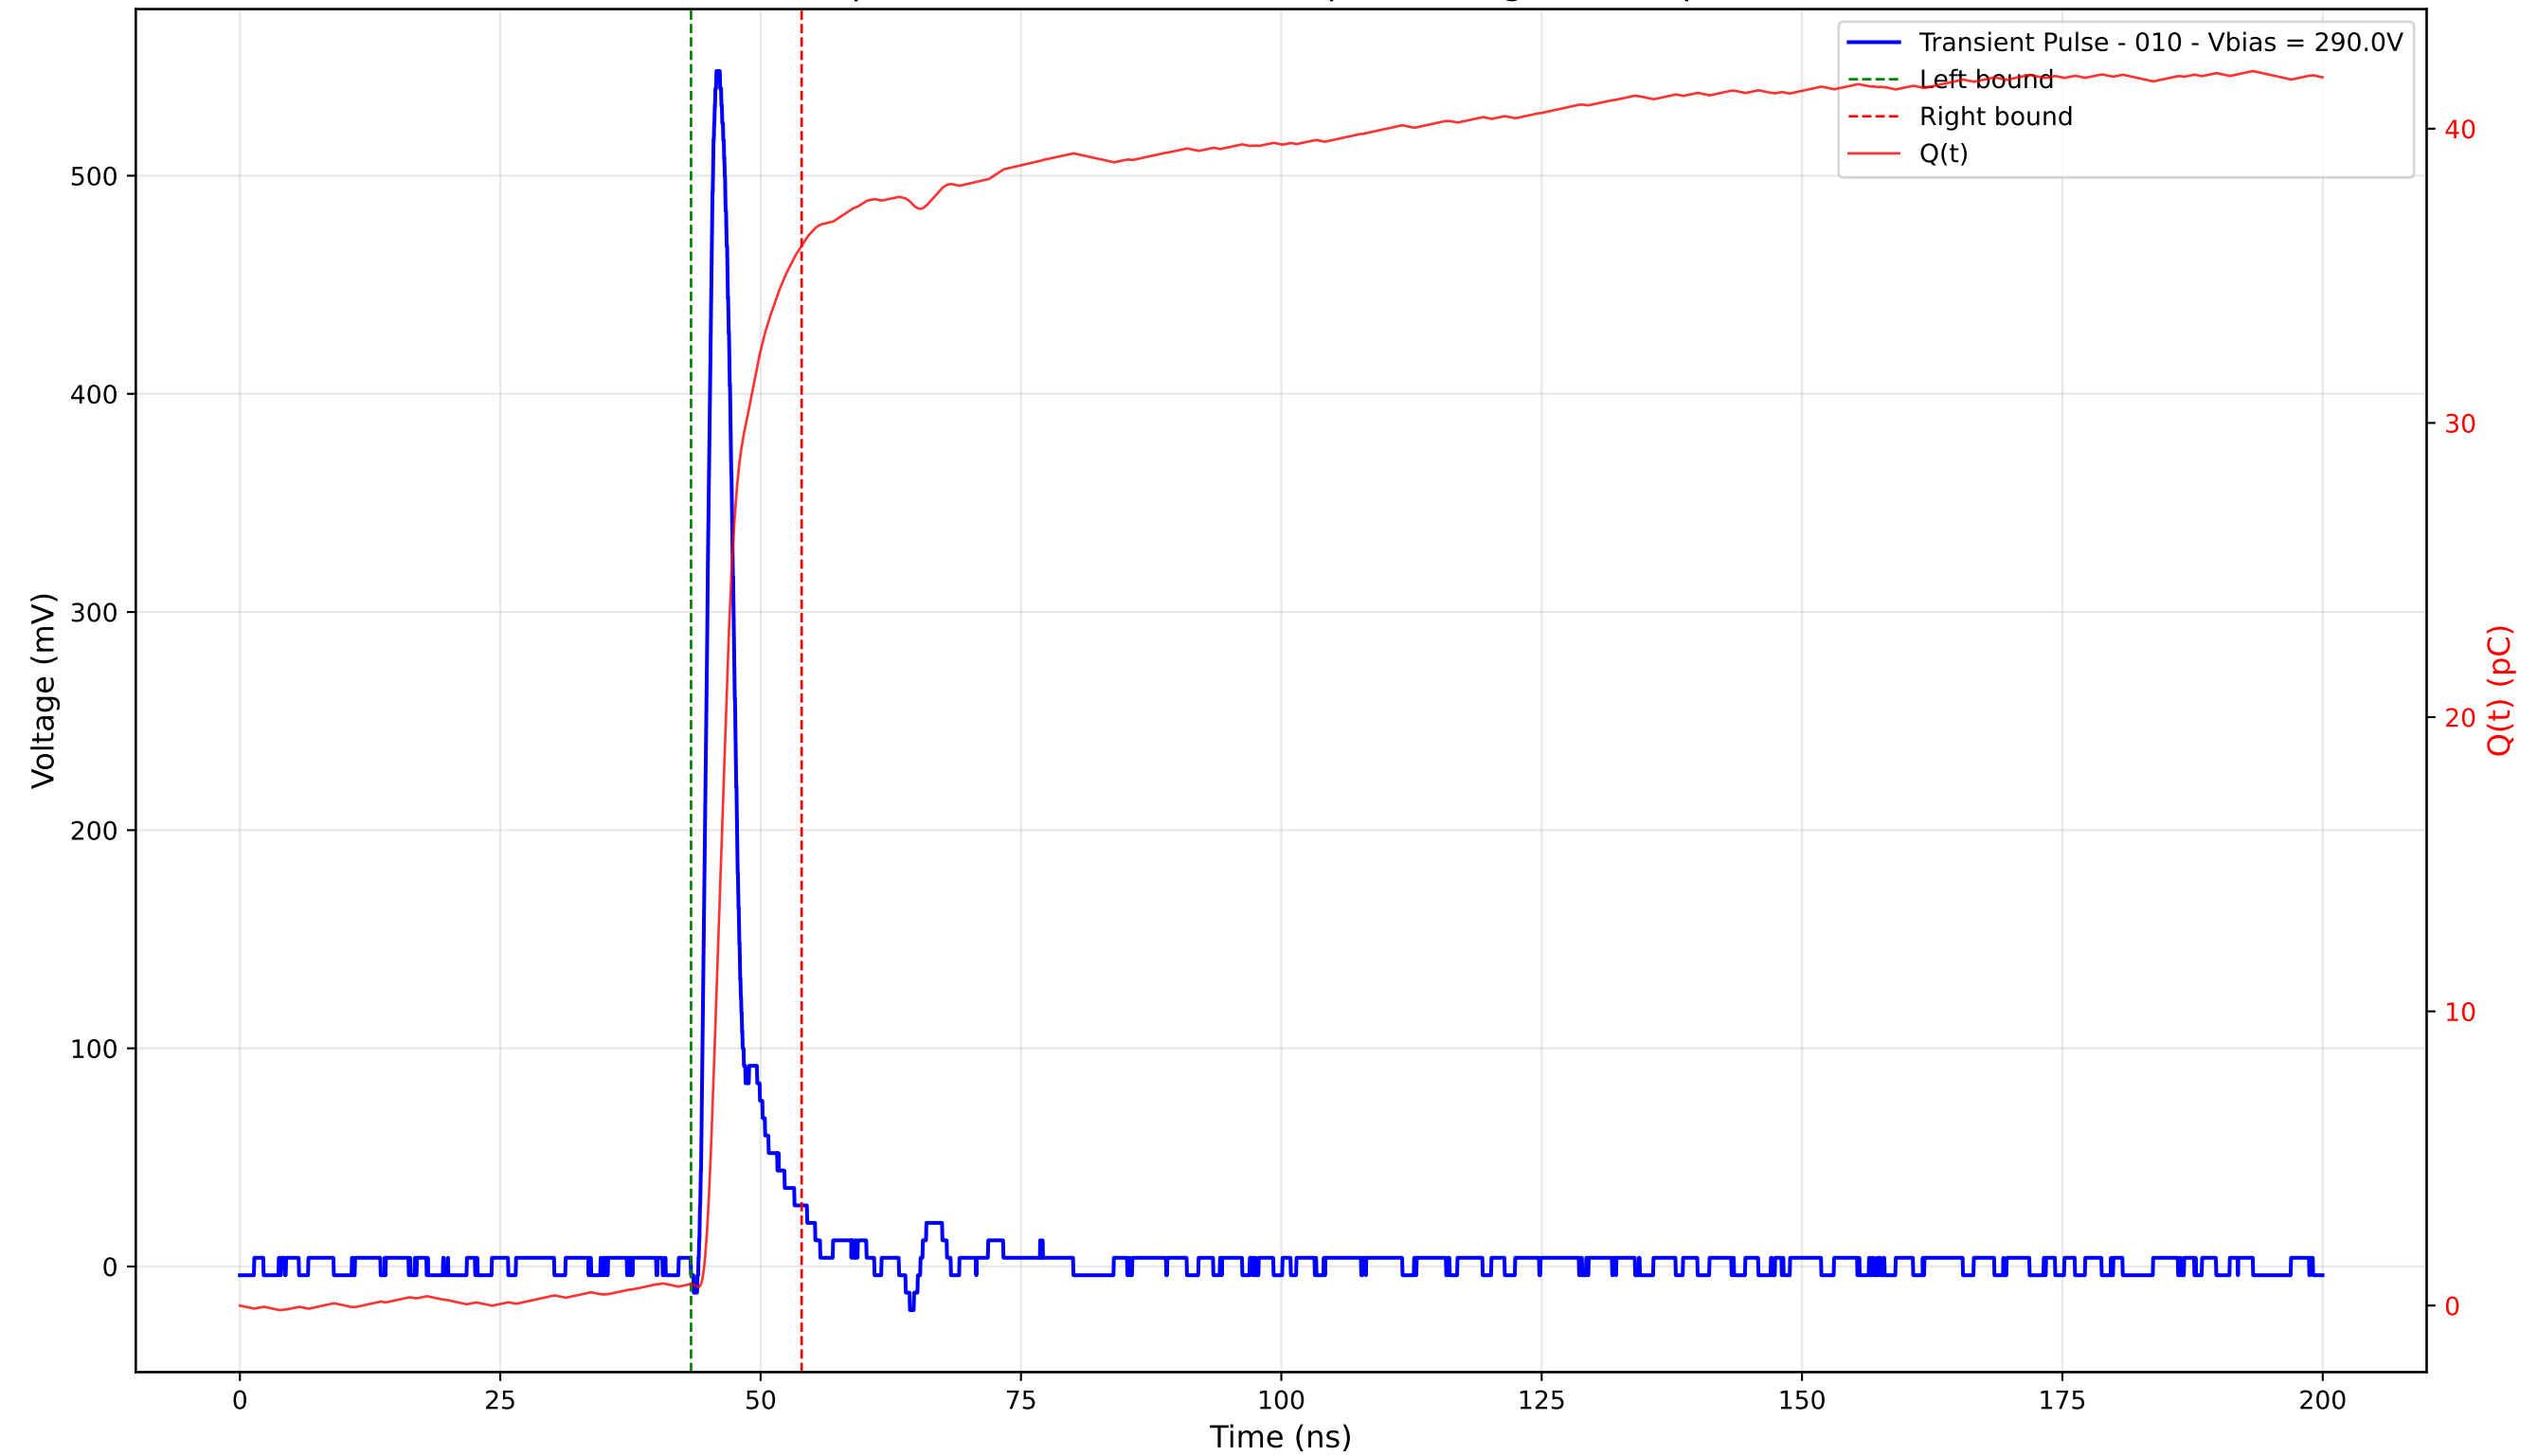


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 34.06 pC - Rise Time: 1.09 ns

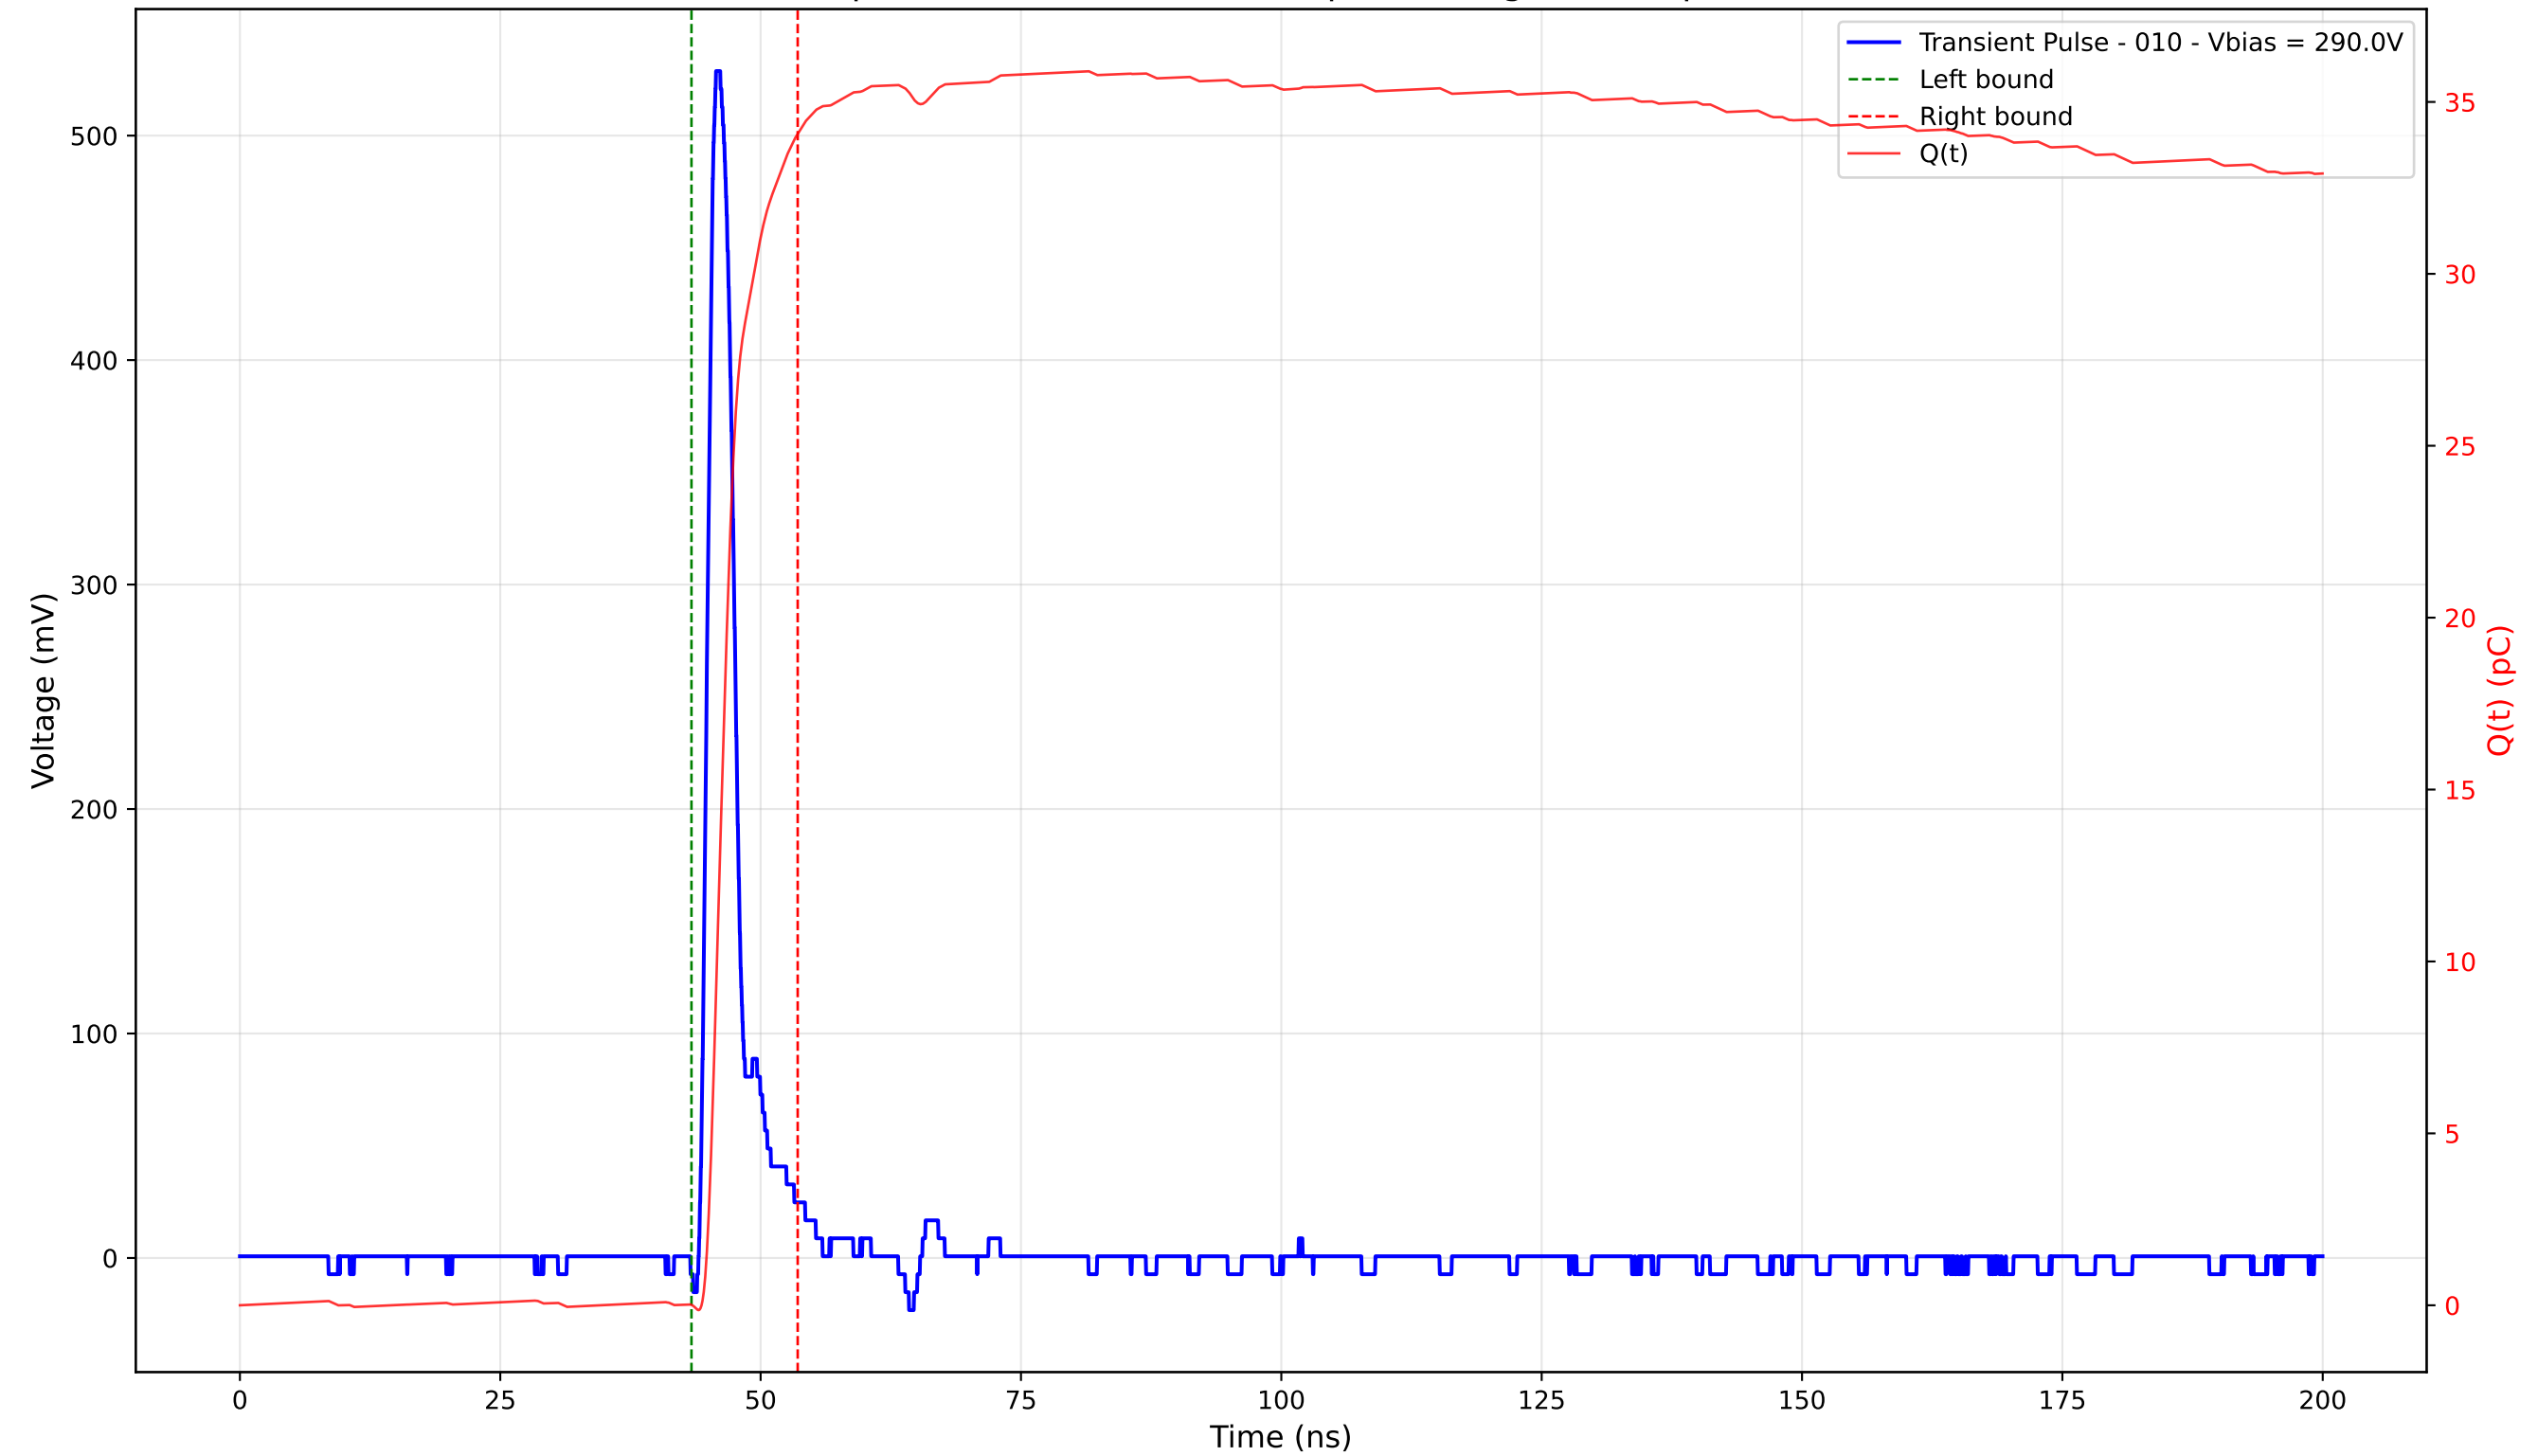


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 34.67 pC - Rise Time: 1.10 ns

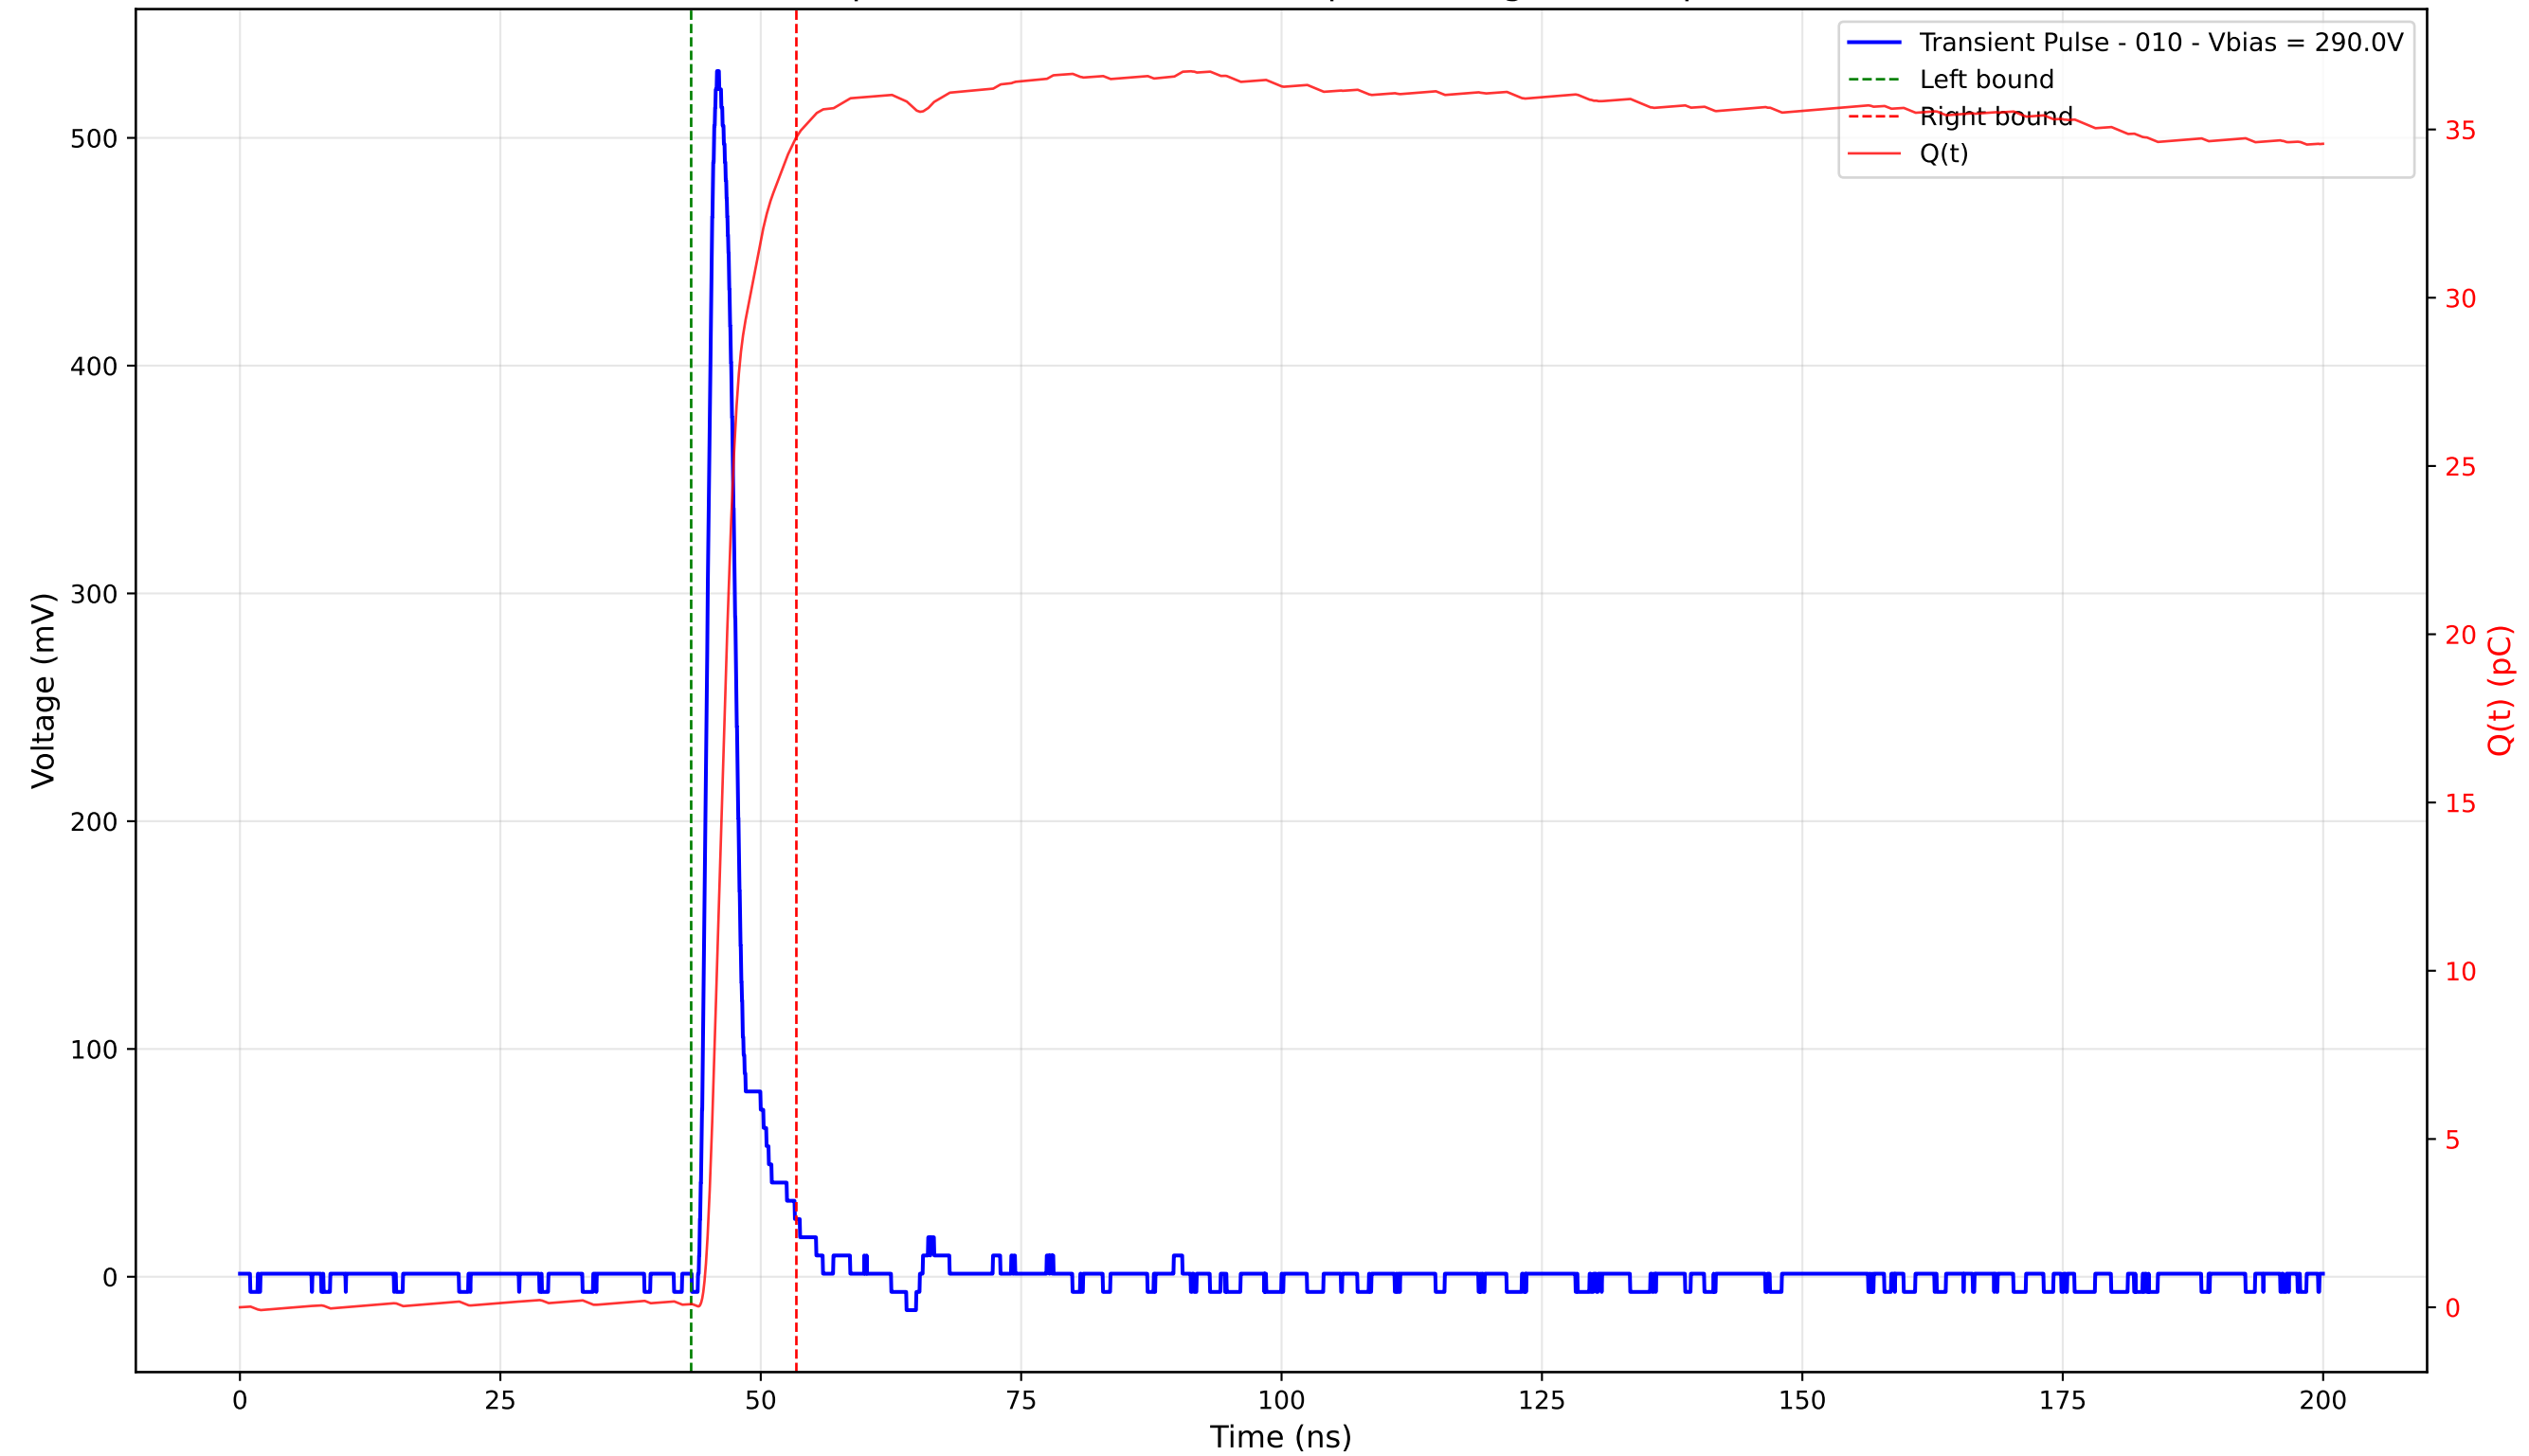


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 34.02 pC - Rise Time: 1.07 ns

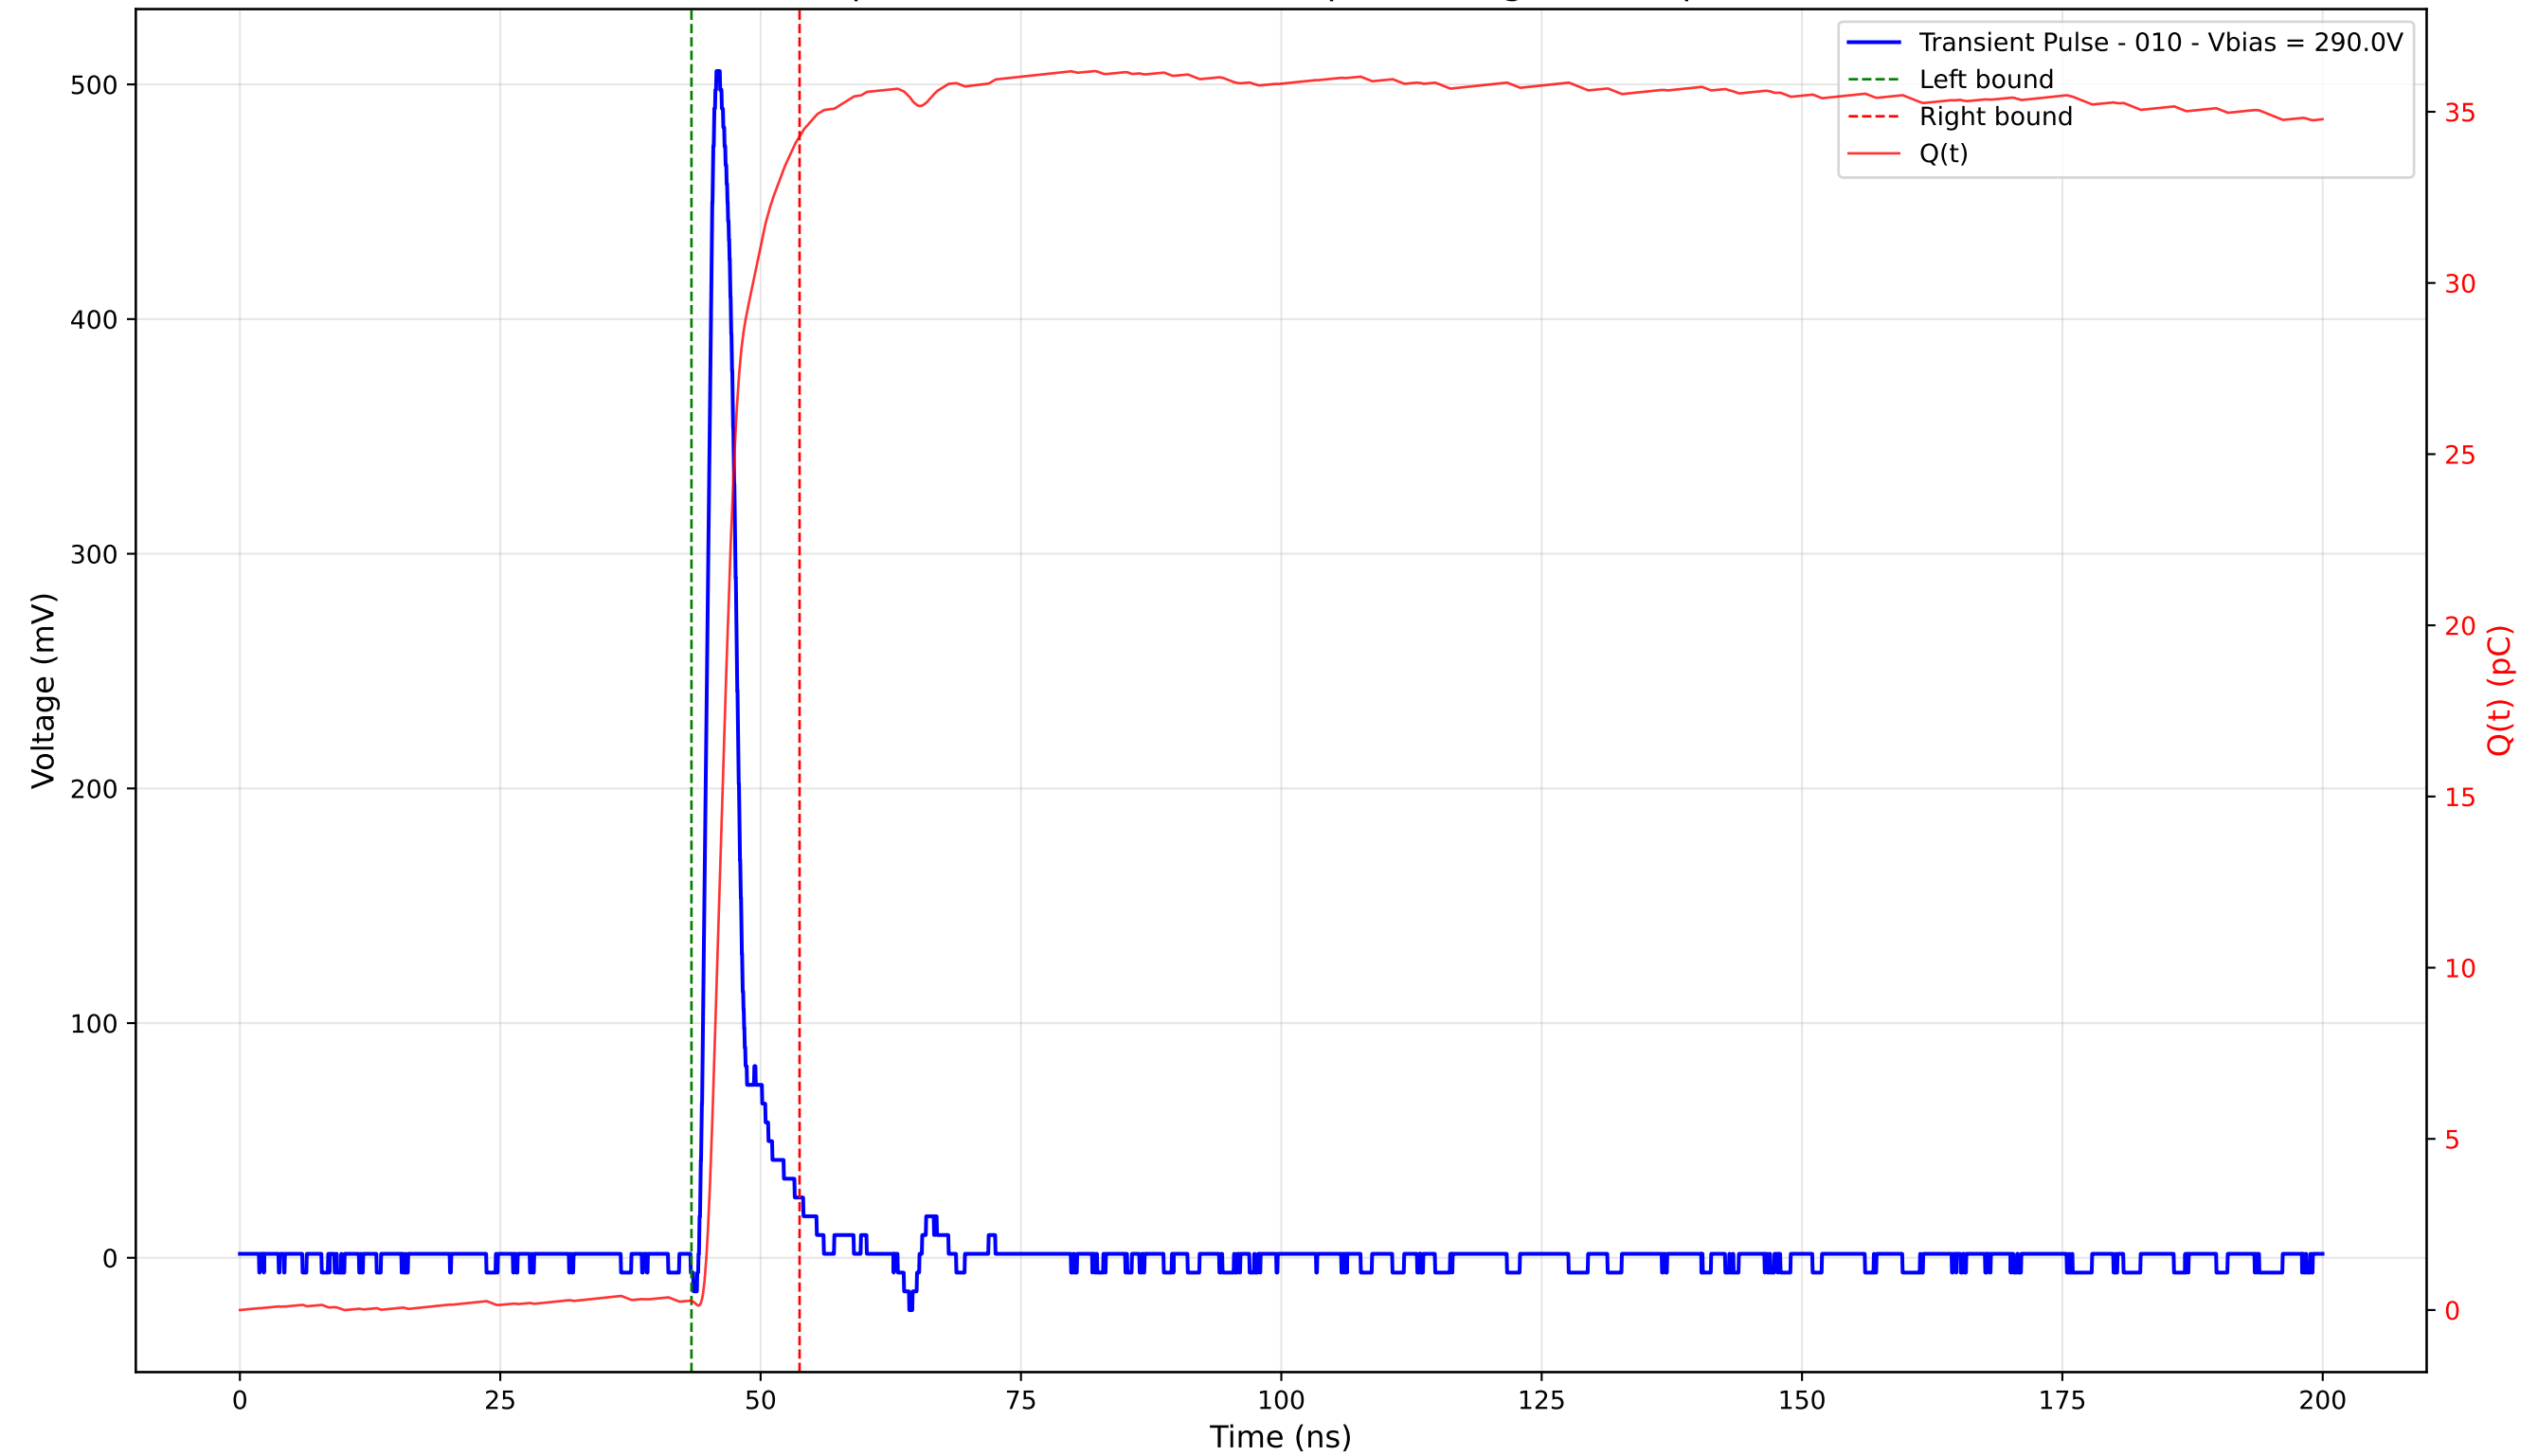


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 34.11 pC - Rise Time: 1.08 ns

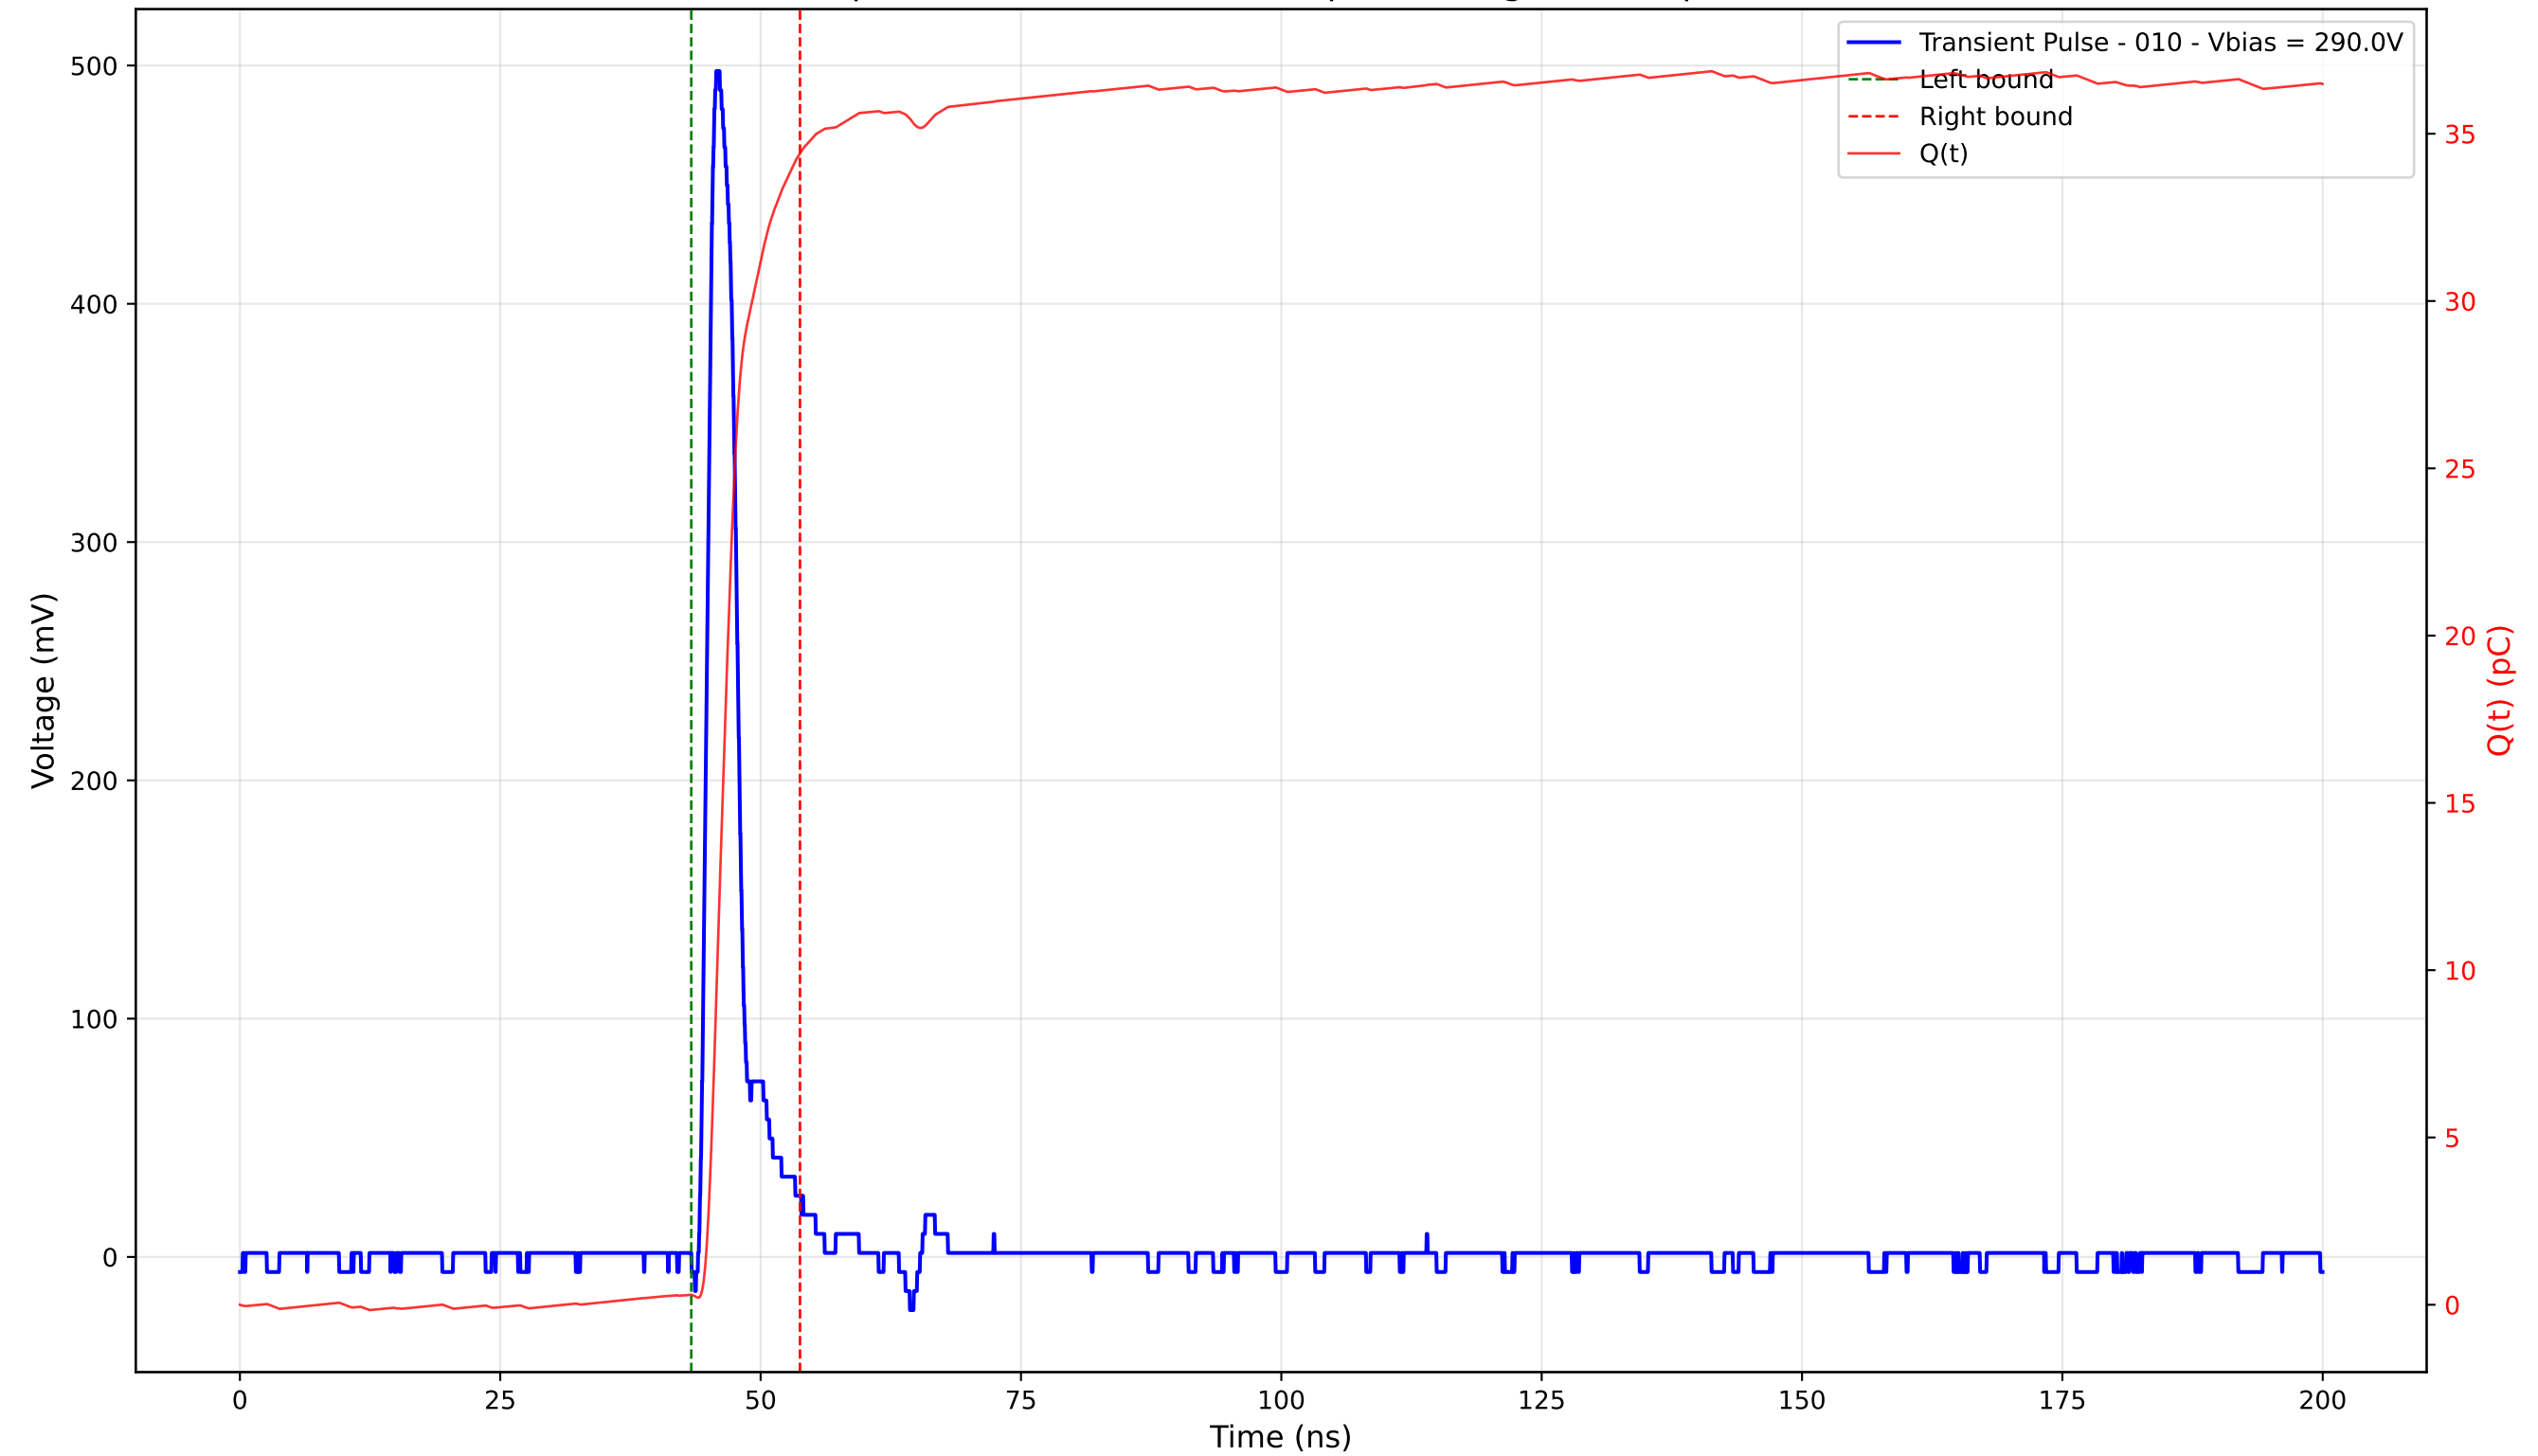


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 33.58 pC - Rise Time: 1.08 ns

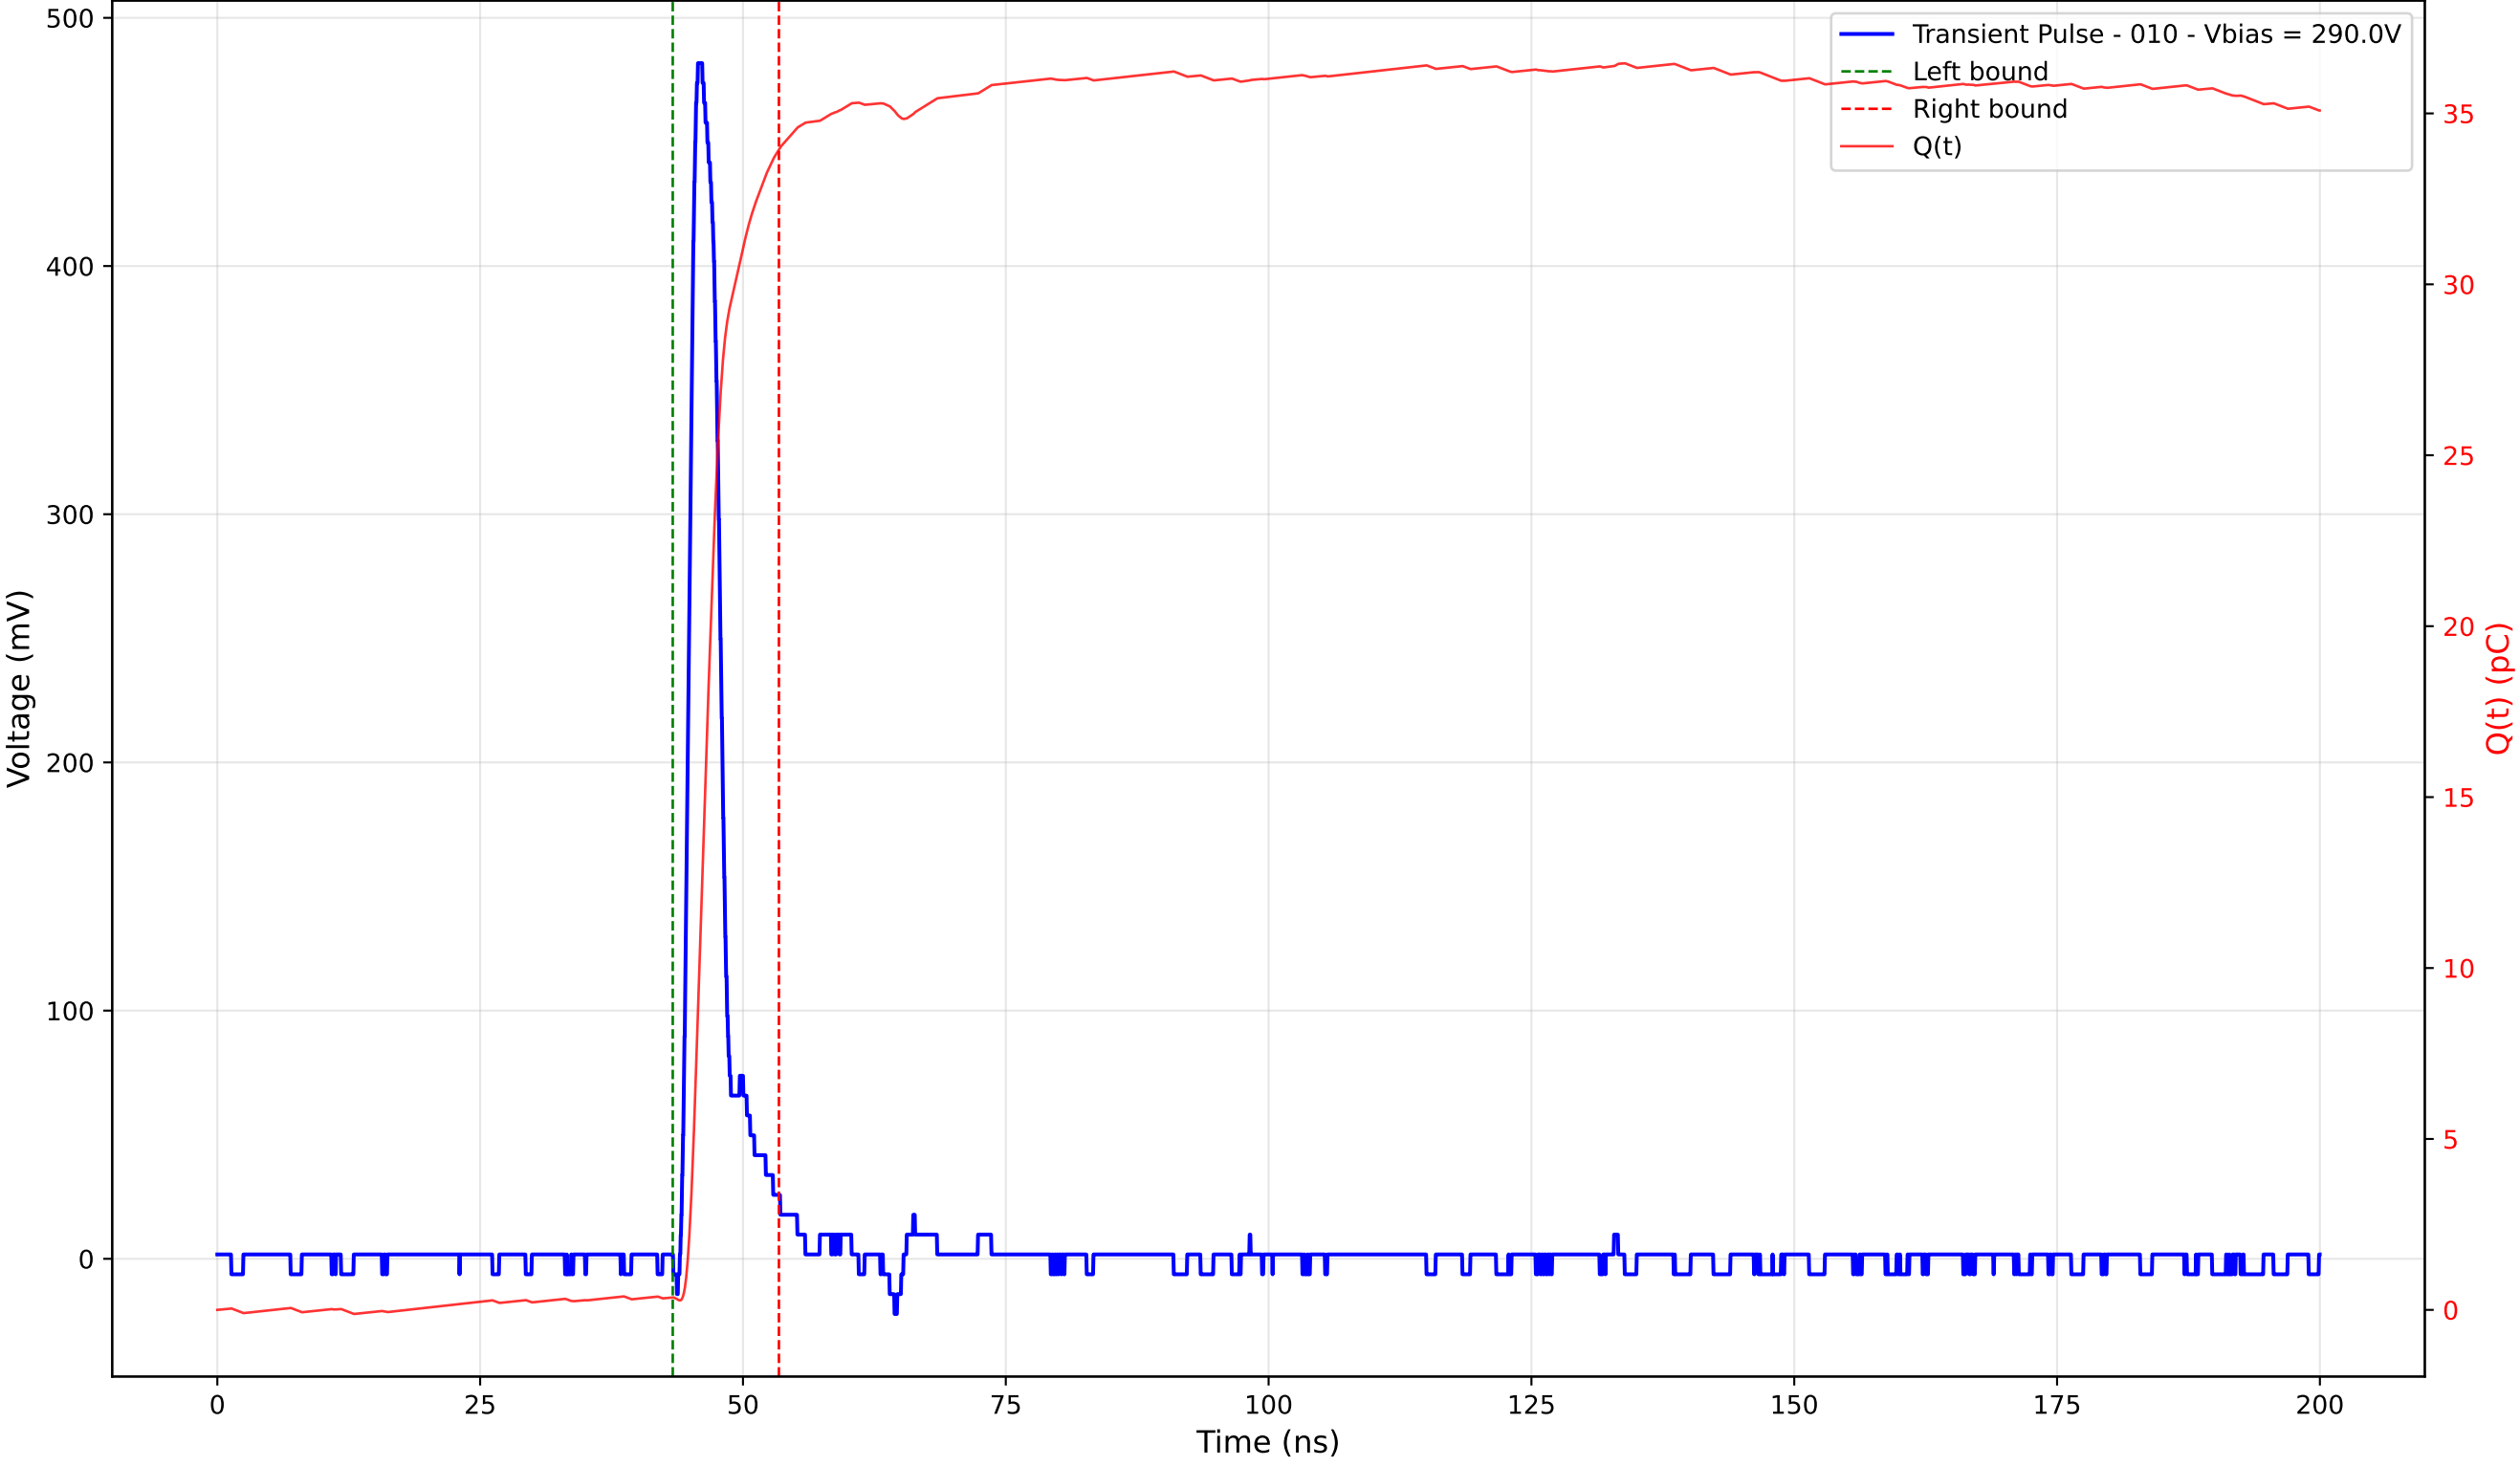


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 33.94 pC - Rise Time: 1.10 ns

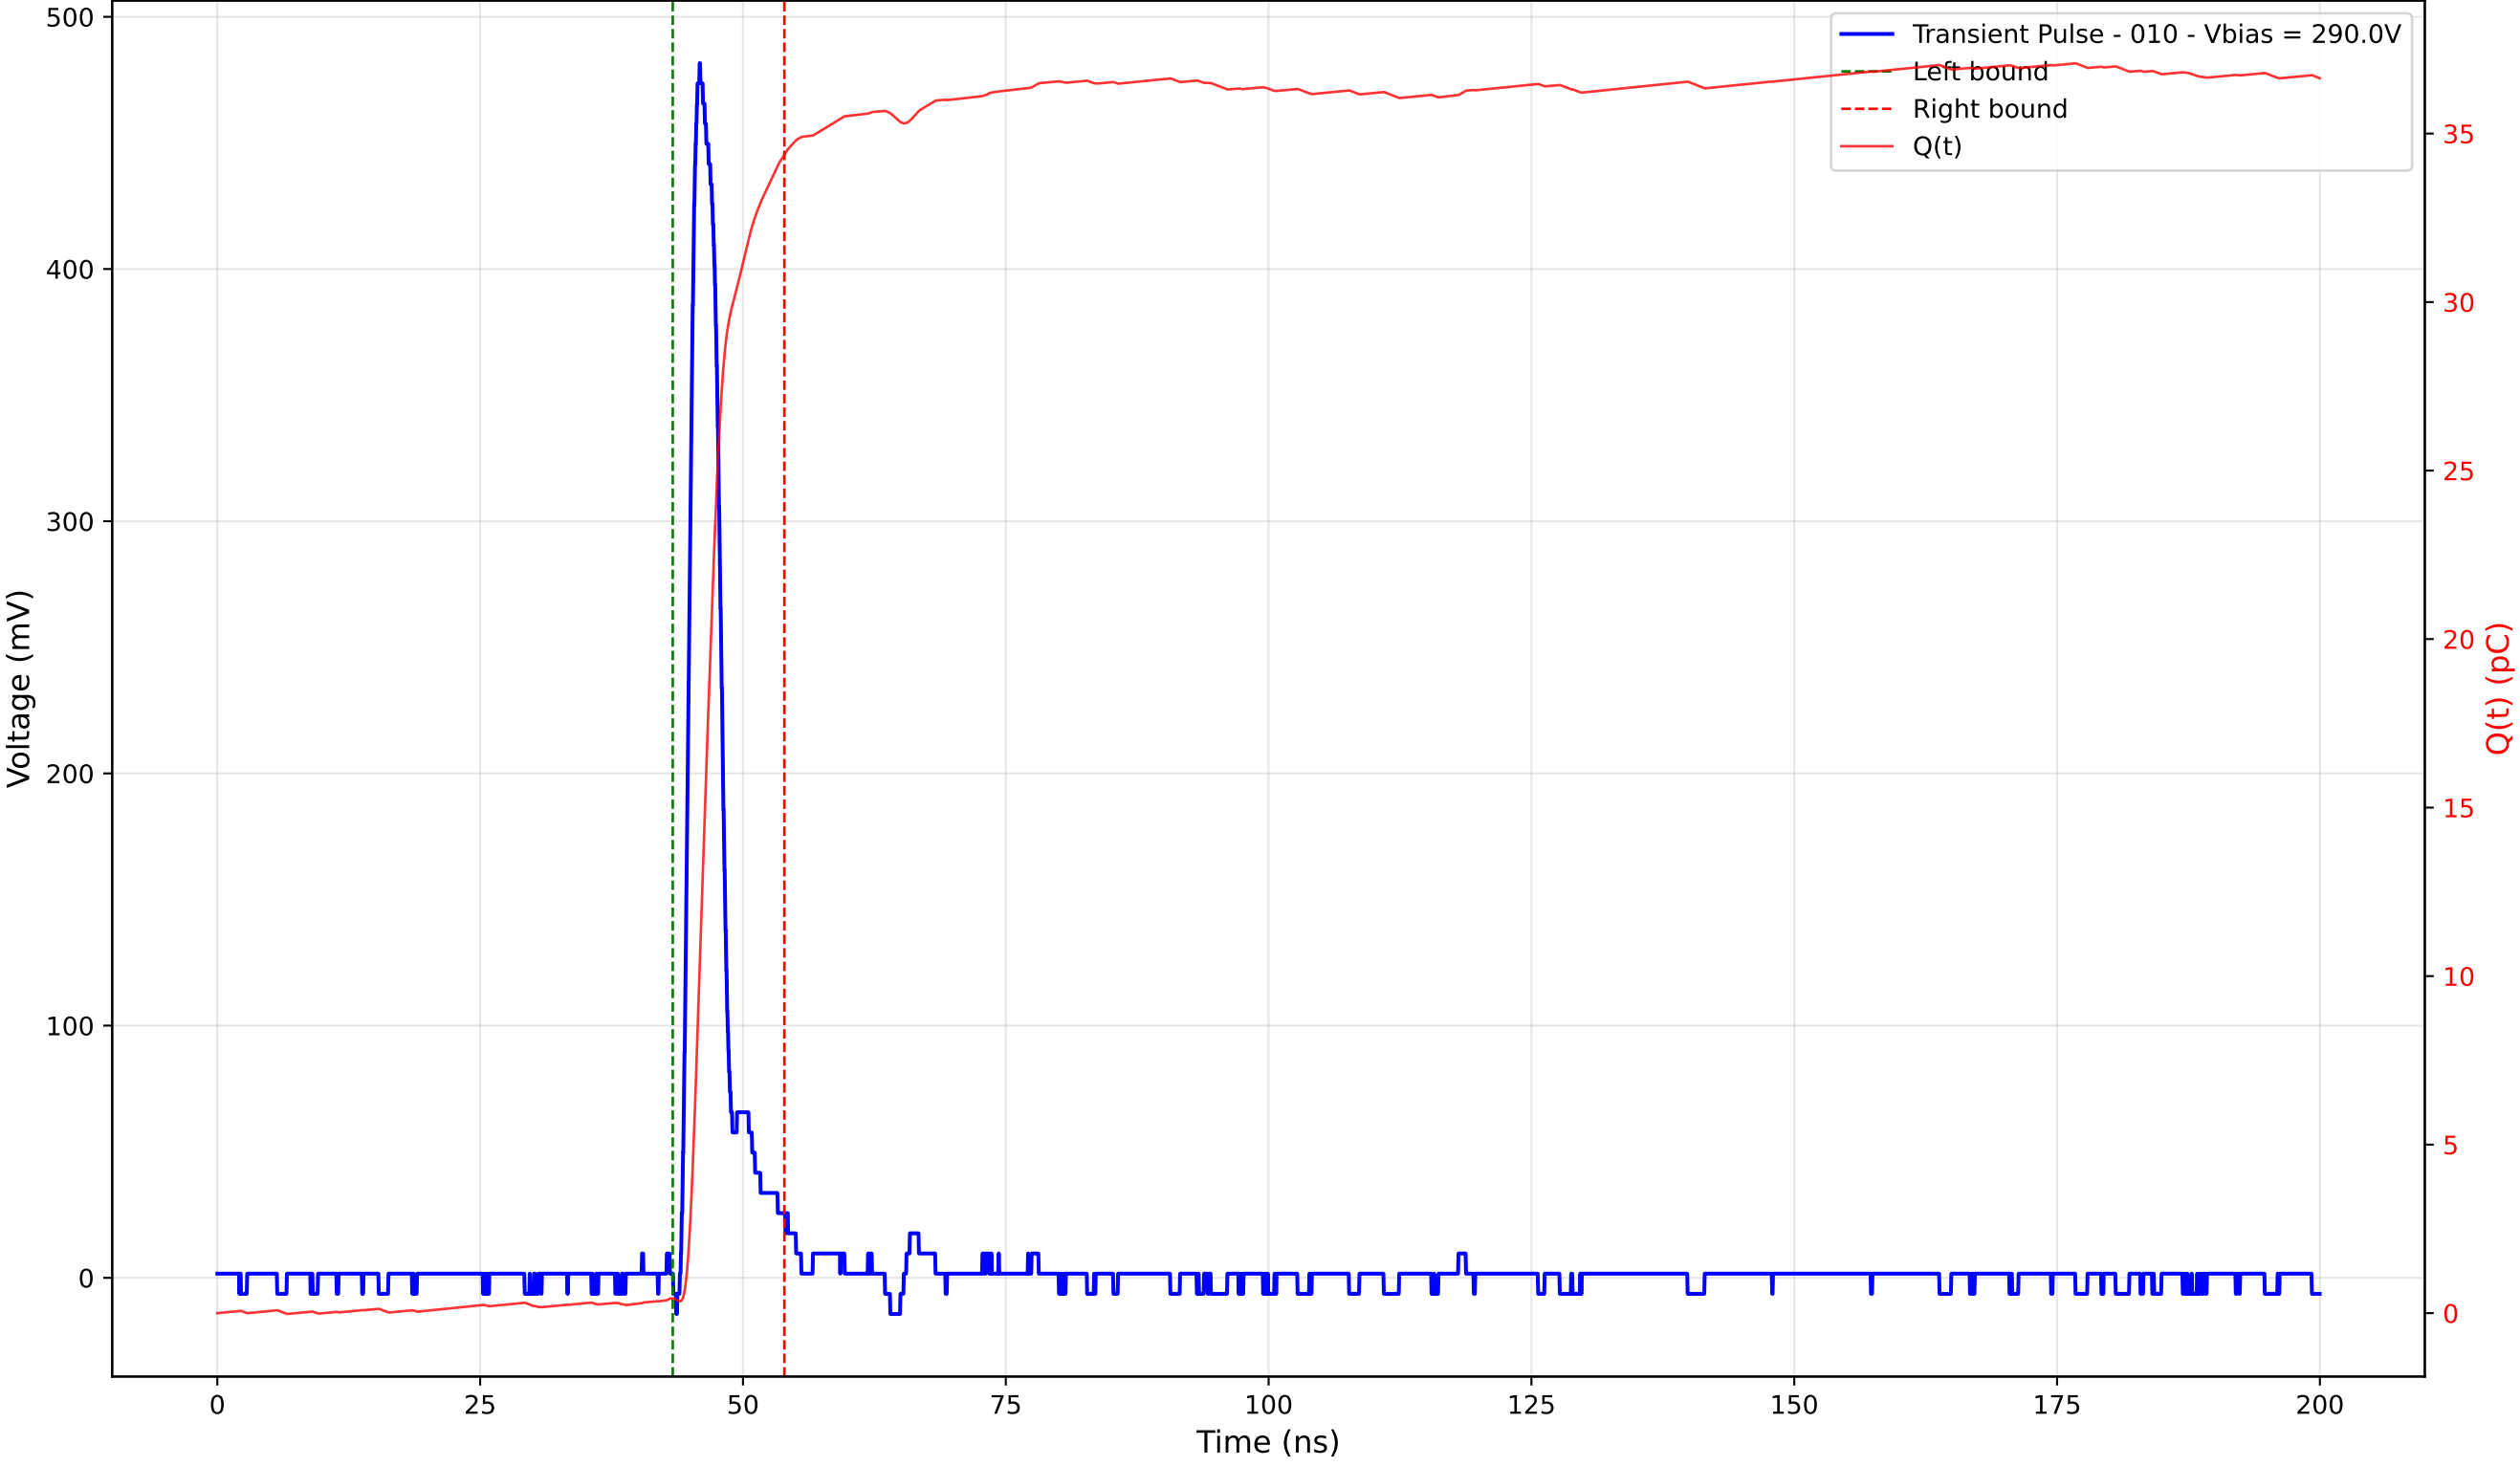


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 34.21 pC - Rise Time: 1.15 ns

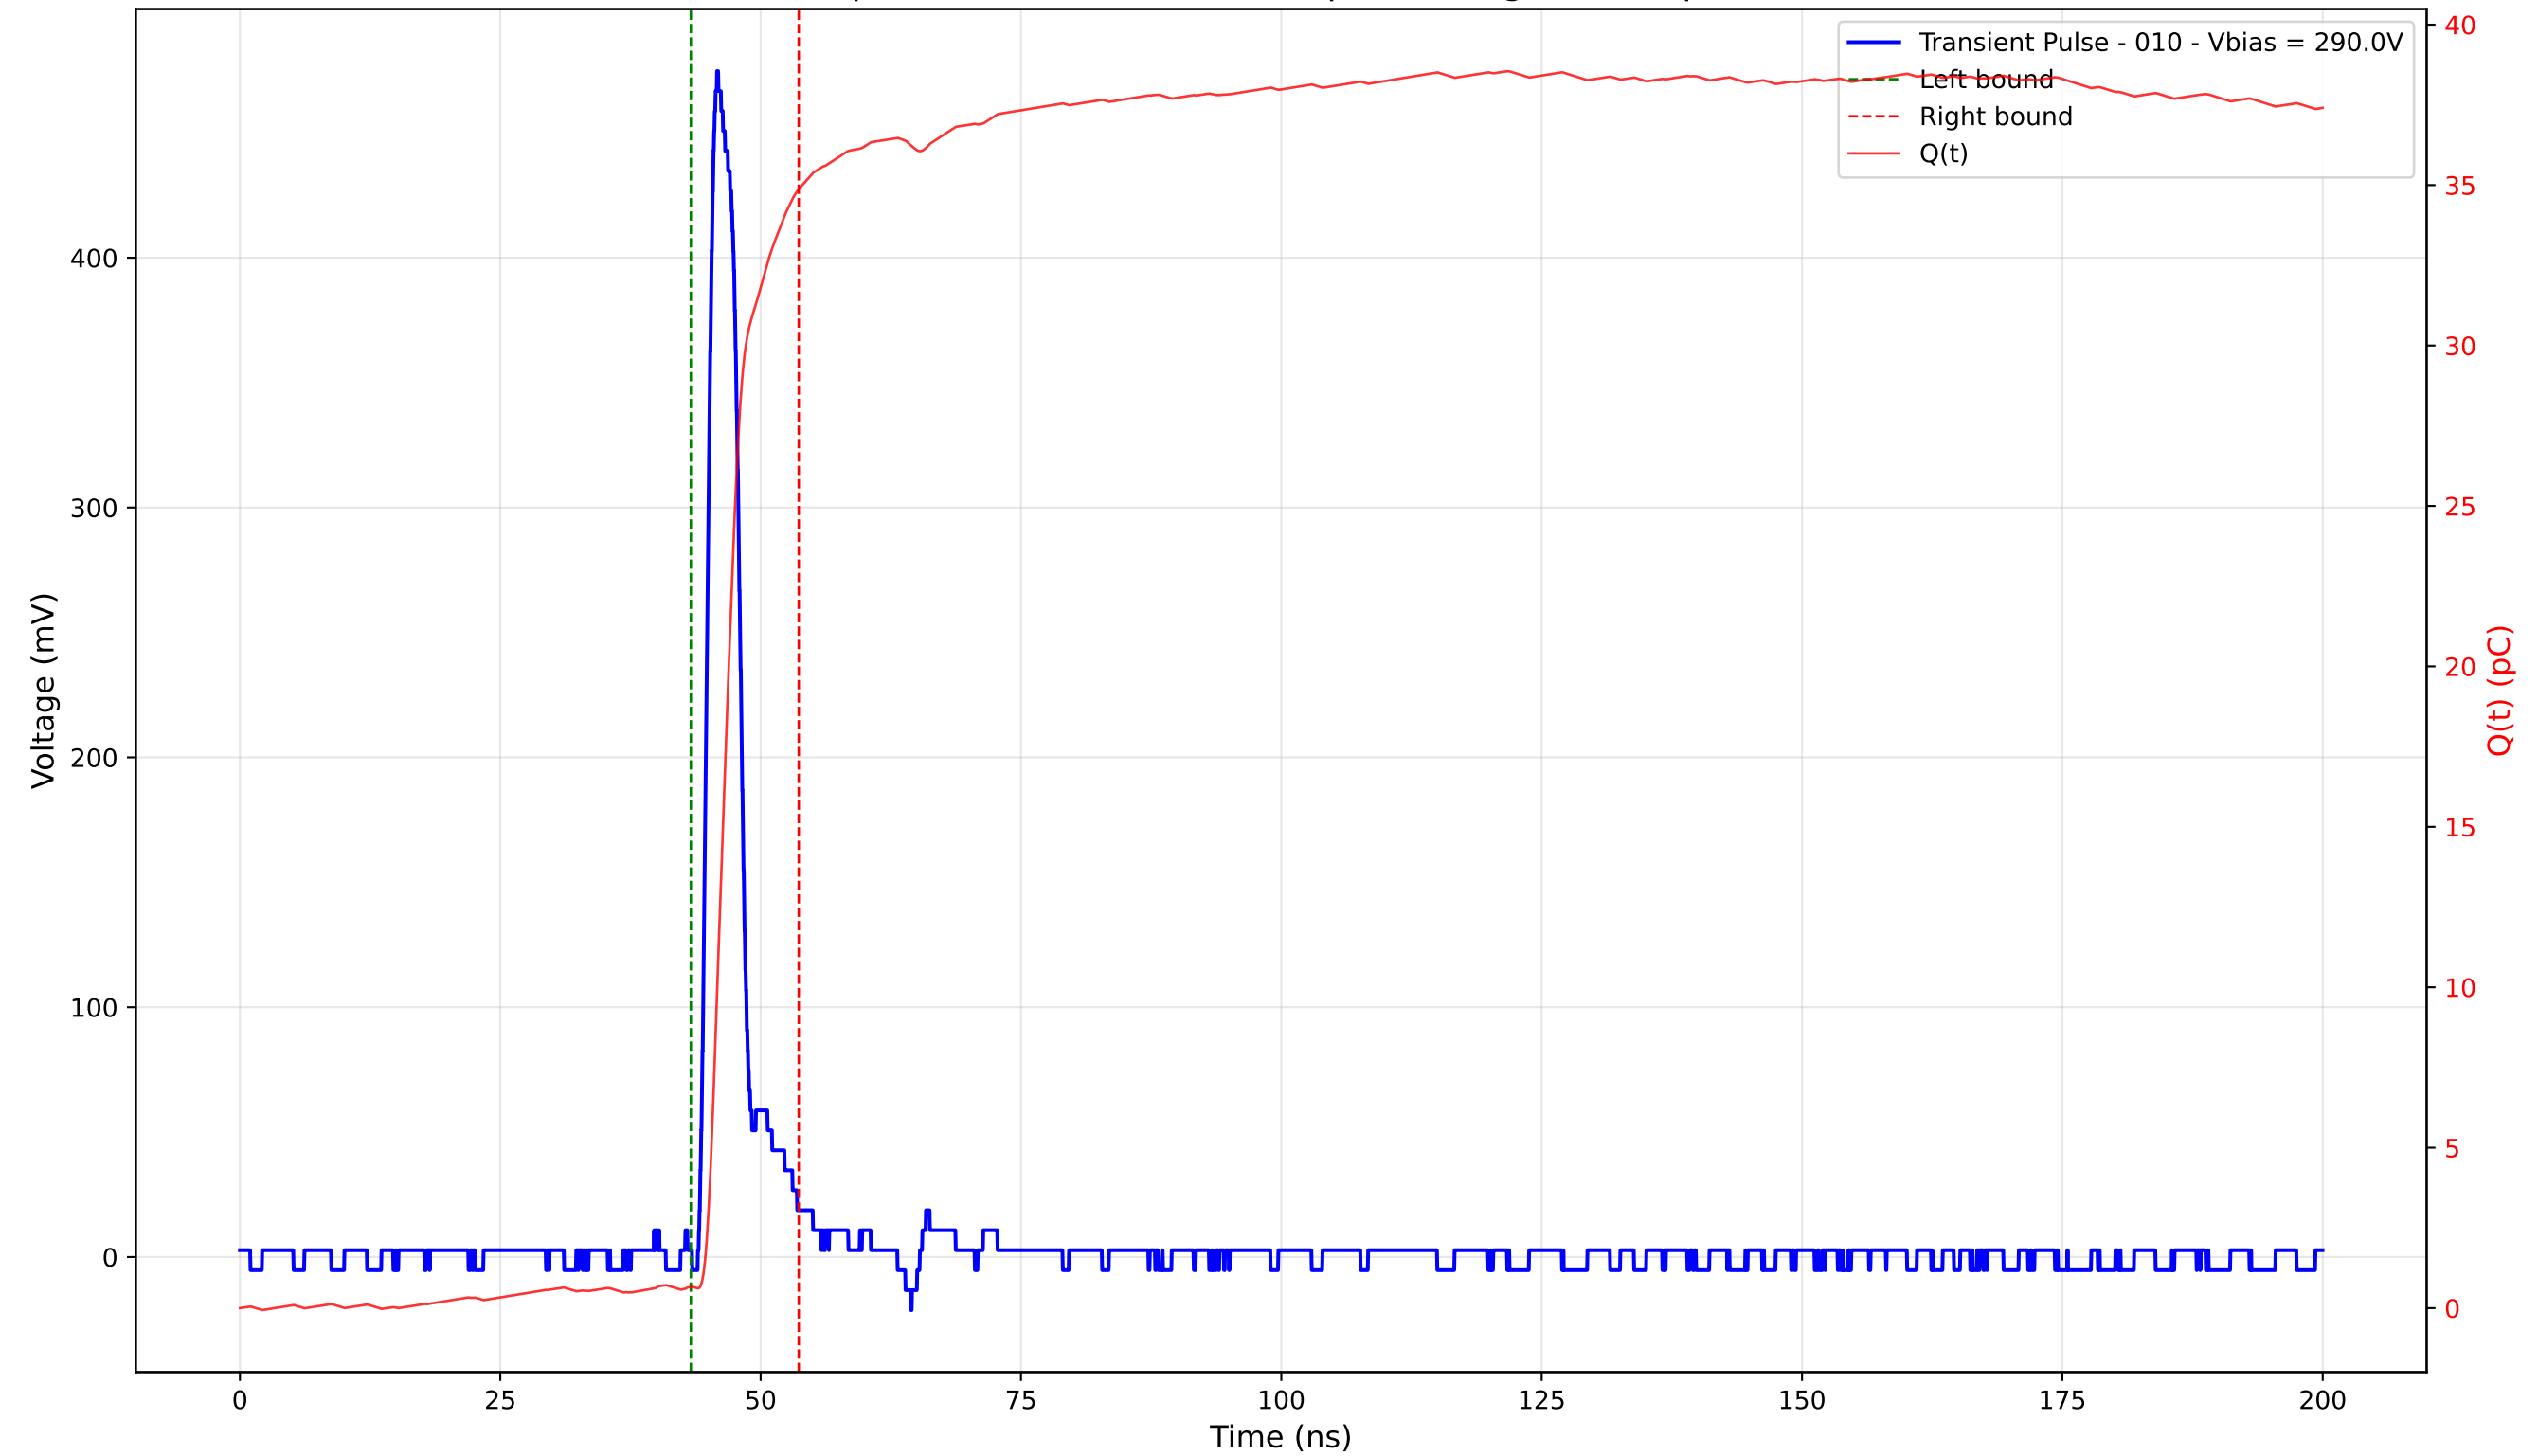


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 33.36 pC - Rise Time: 1.07 ns

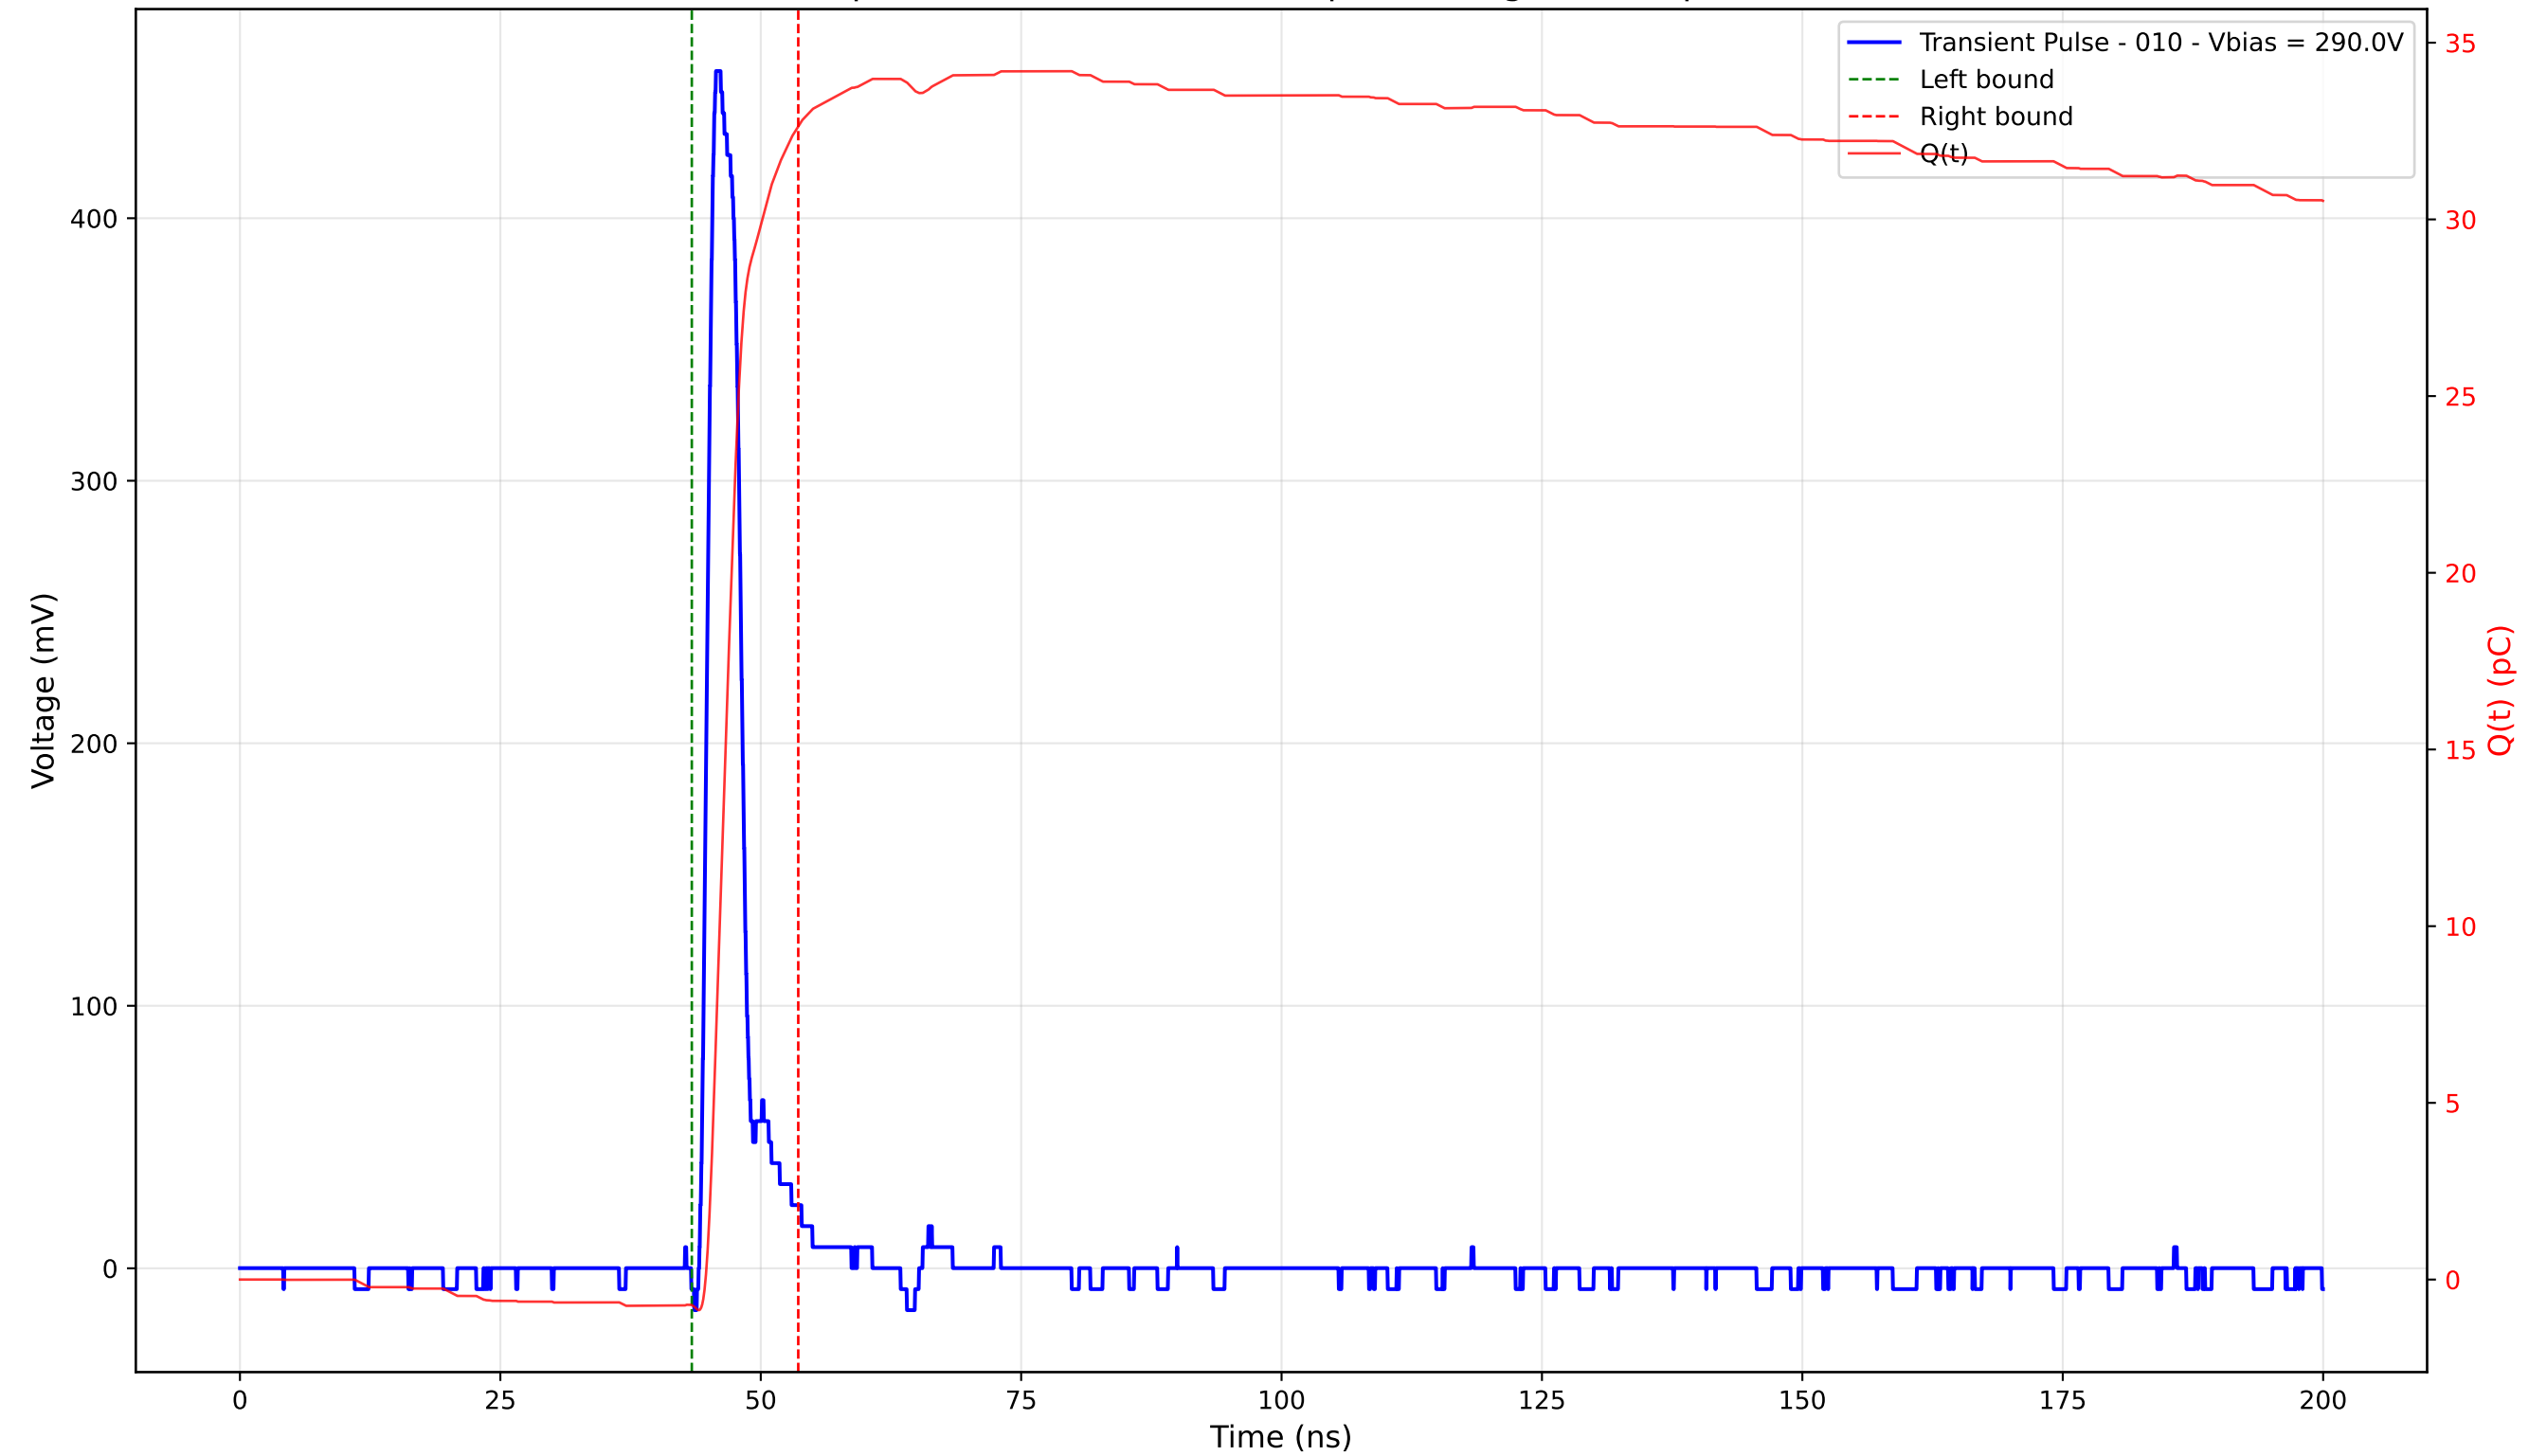


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 33.97 pC - Rise Time: 1.10 ns

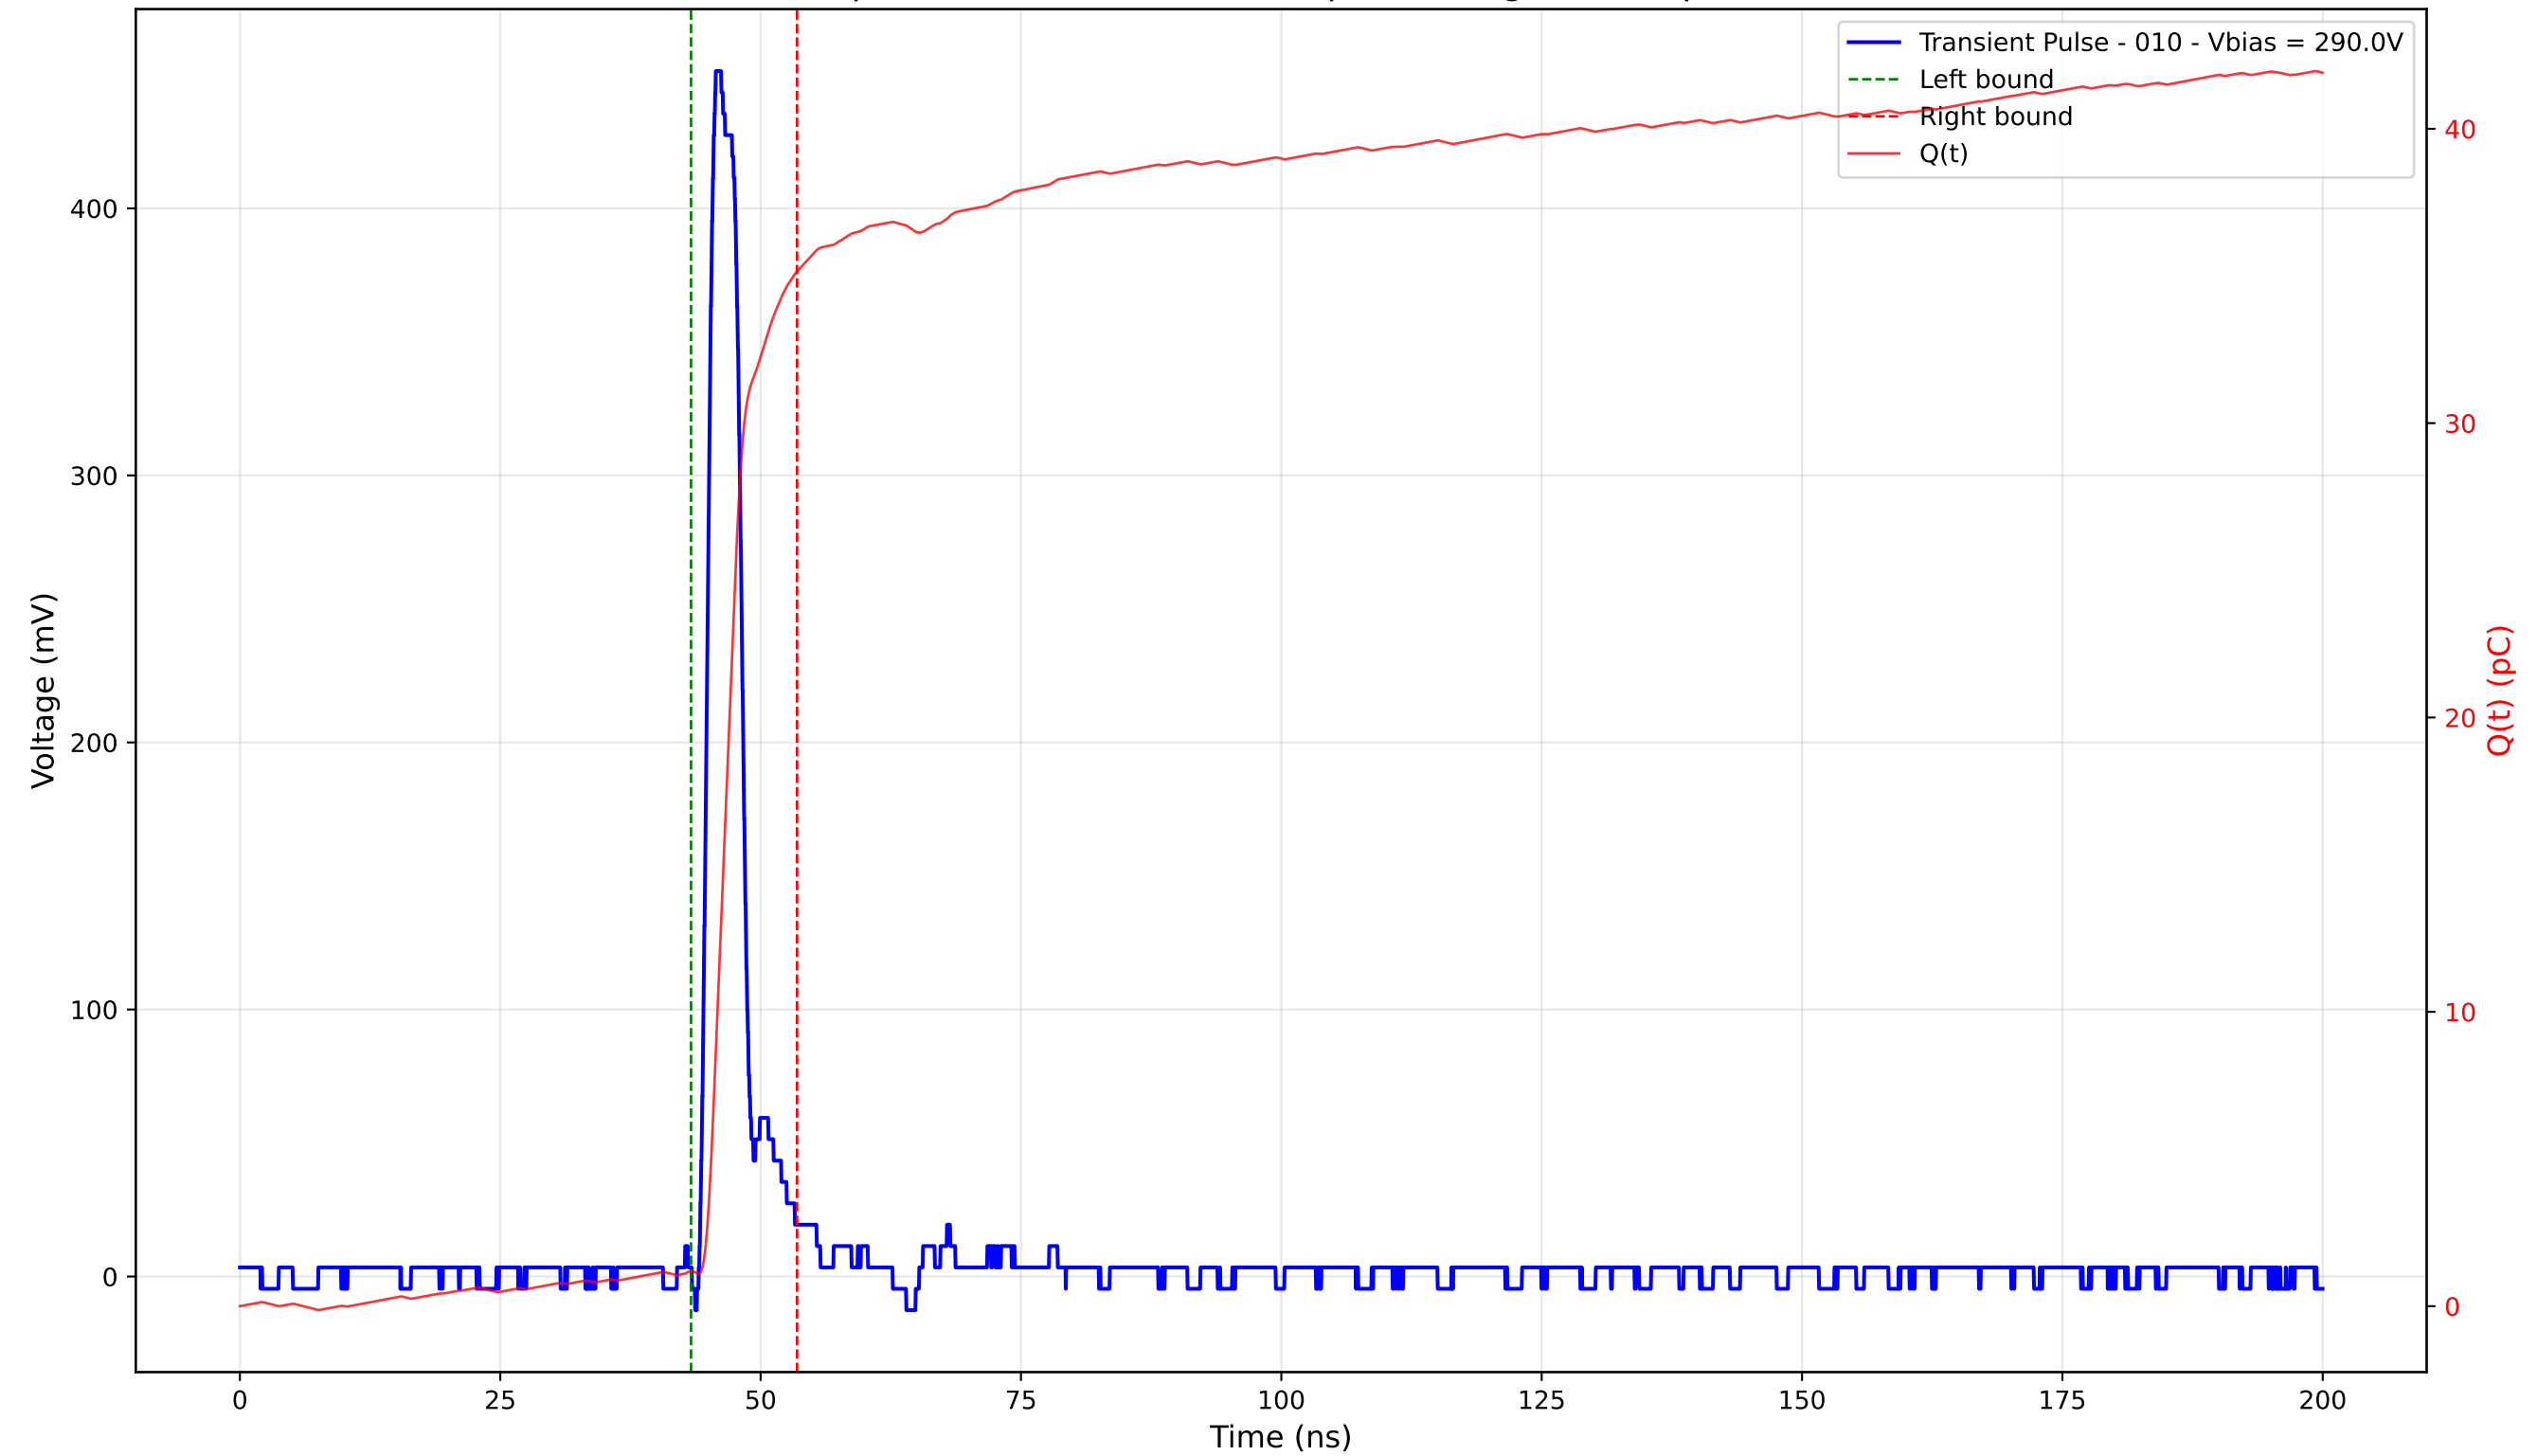


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 33.73 pC - Rise Time: 1.13 ns

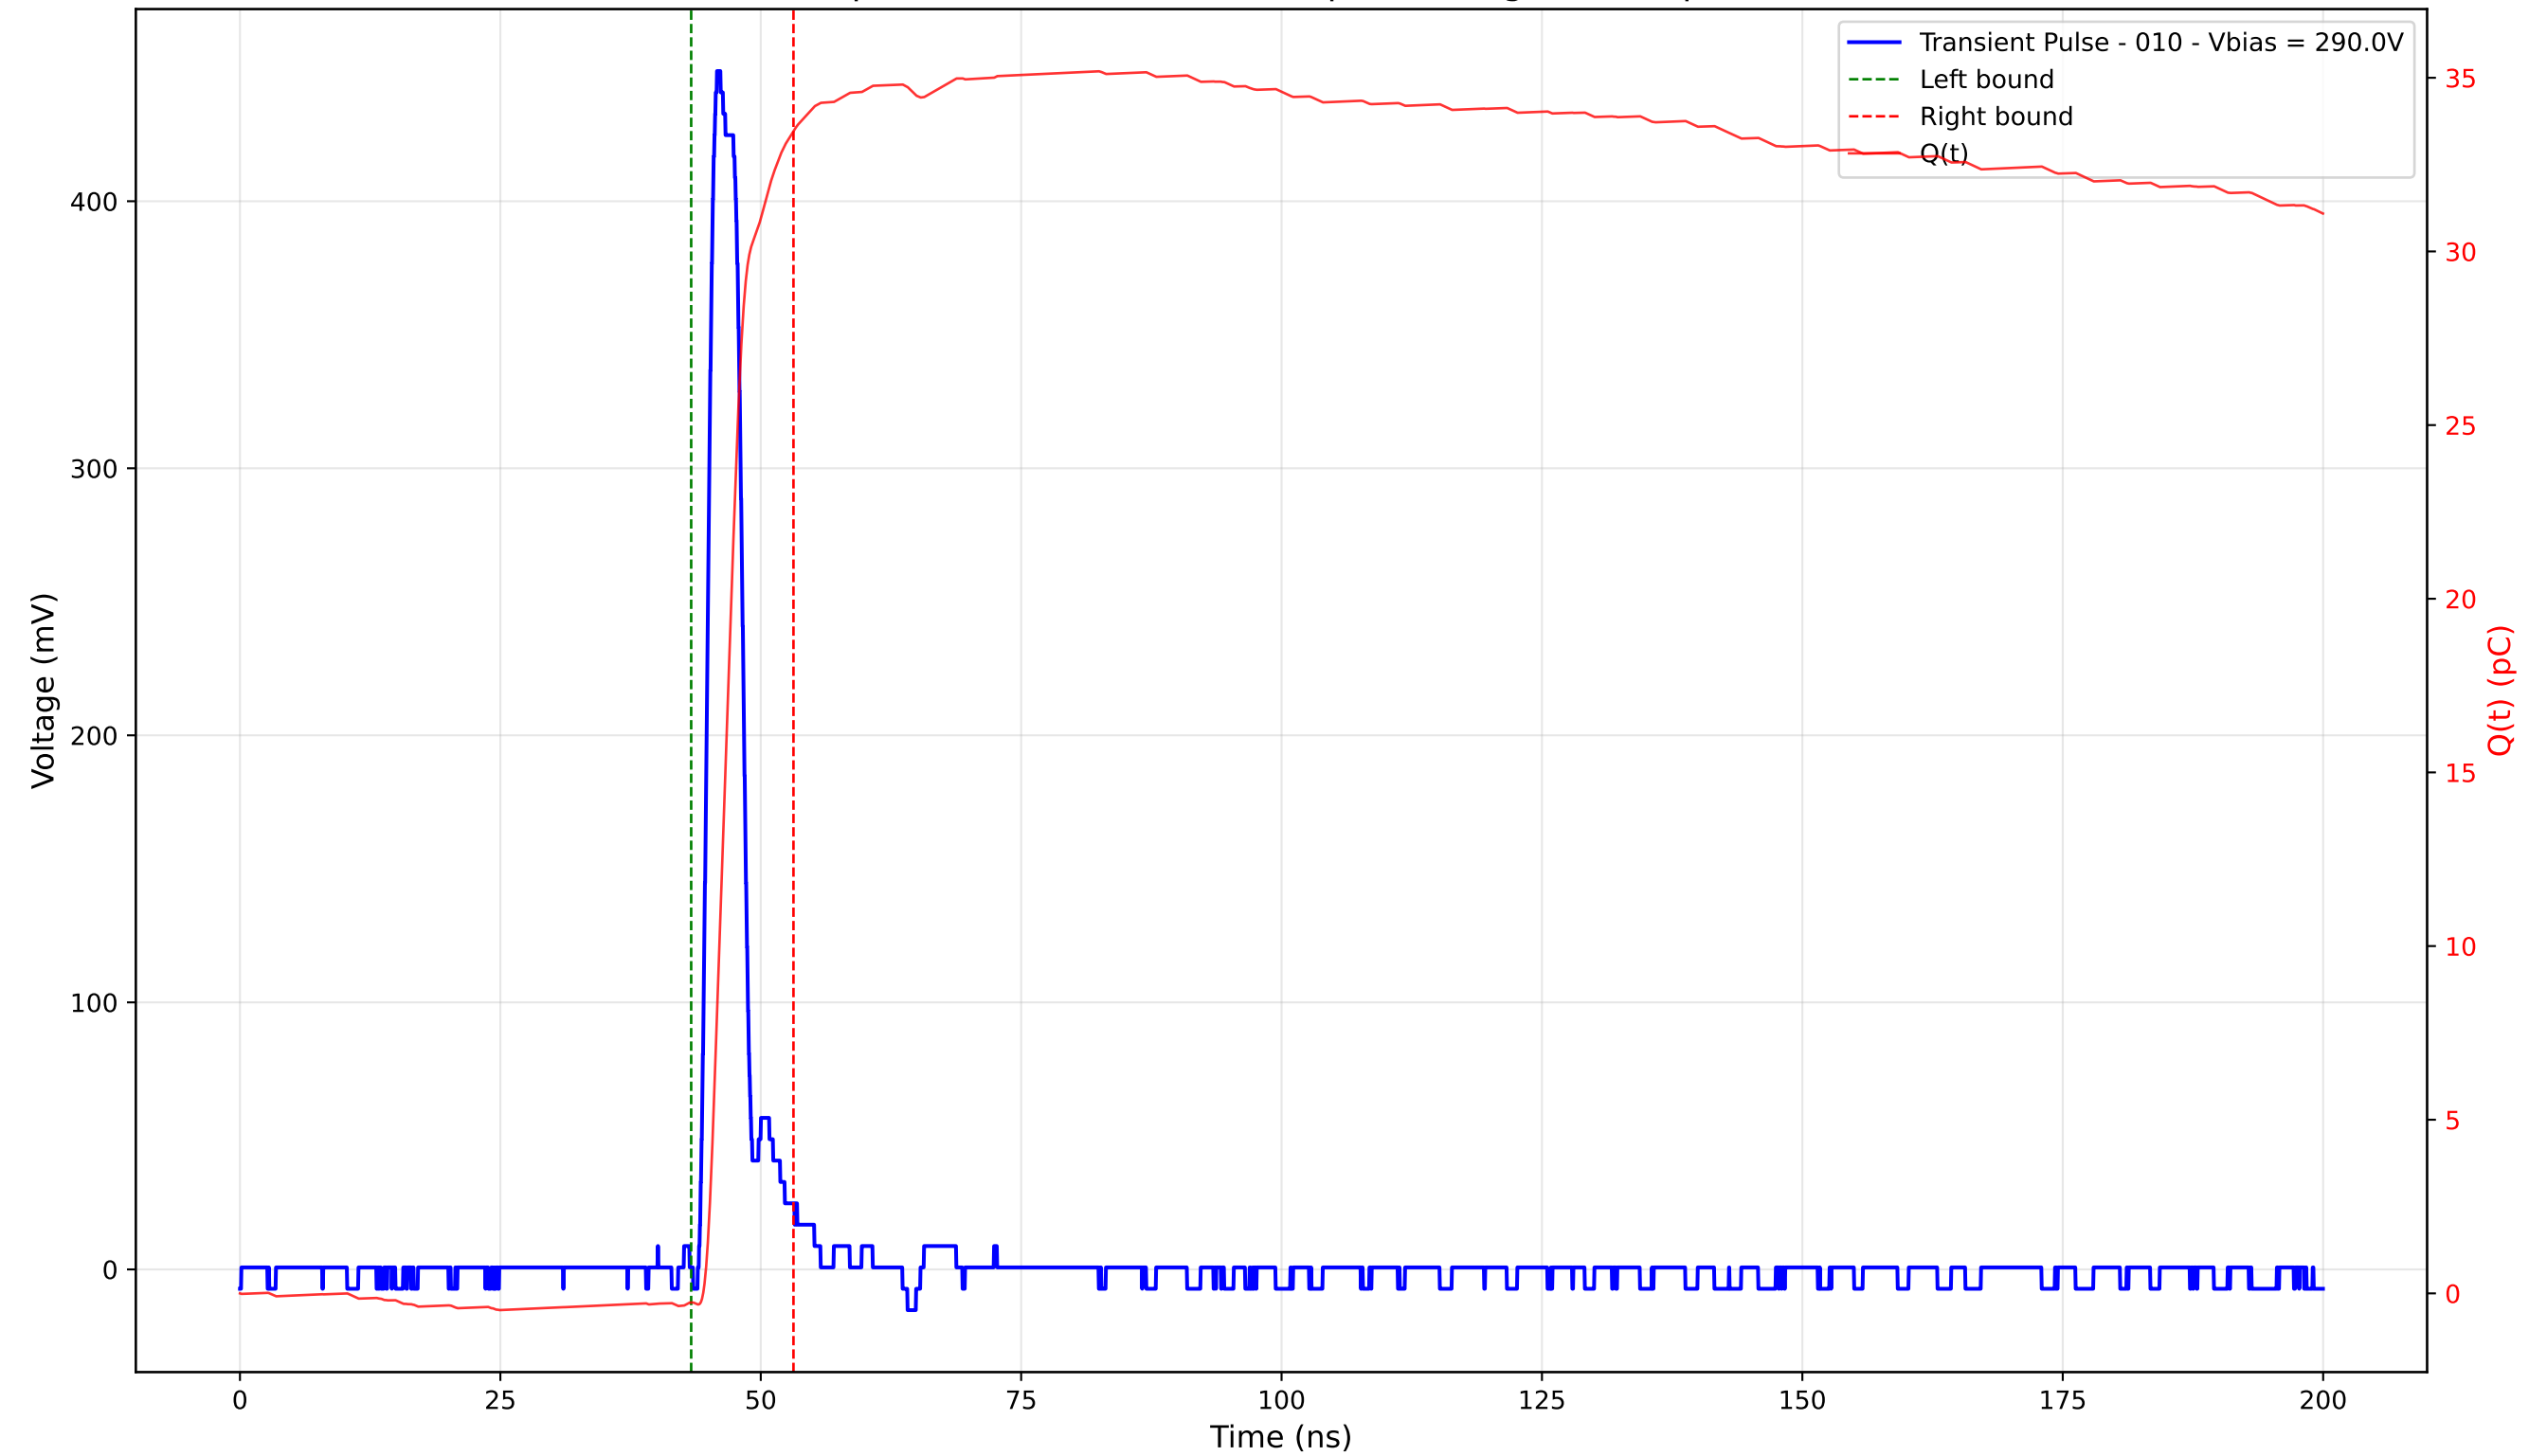


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 34.37 pC - Rise Time: 1.14 ns

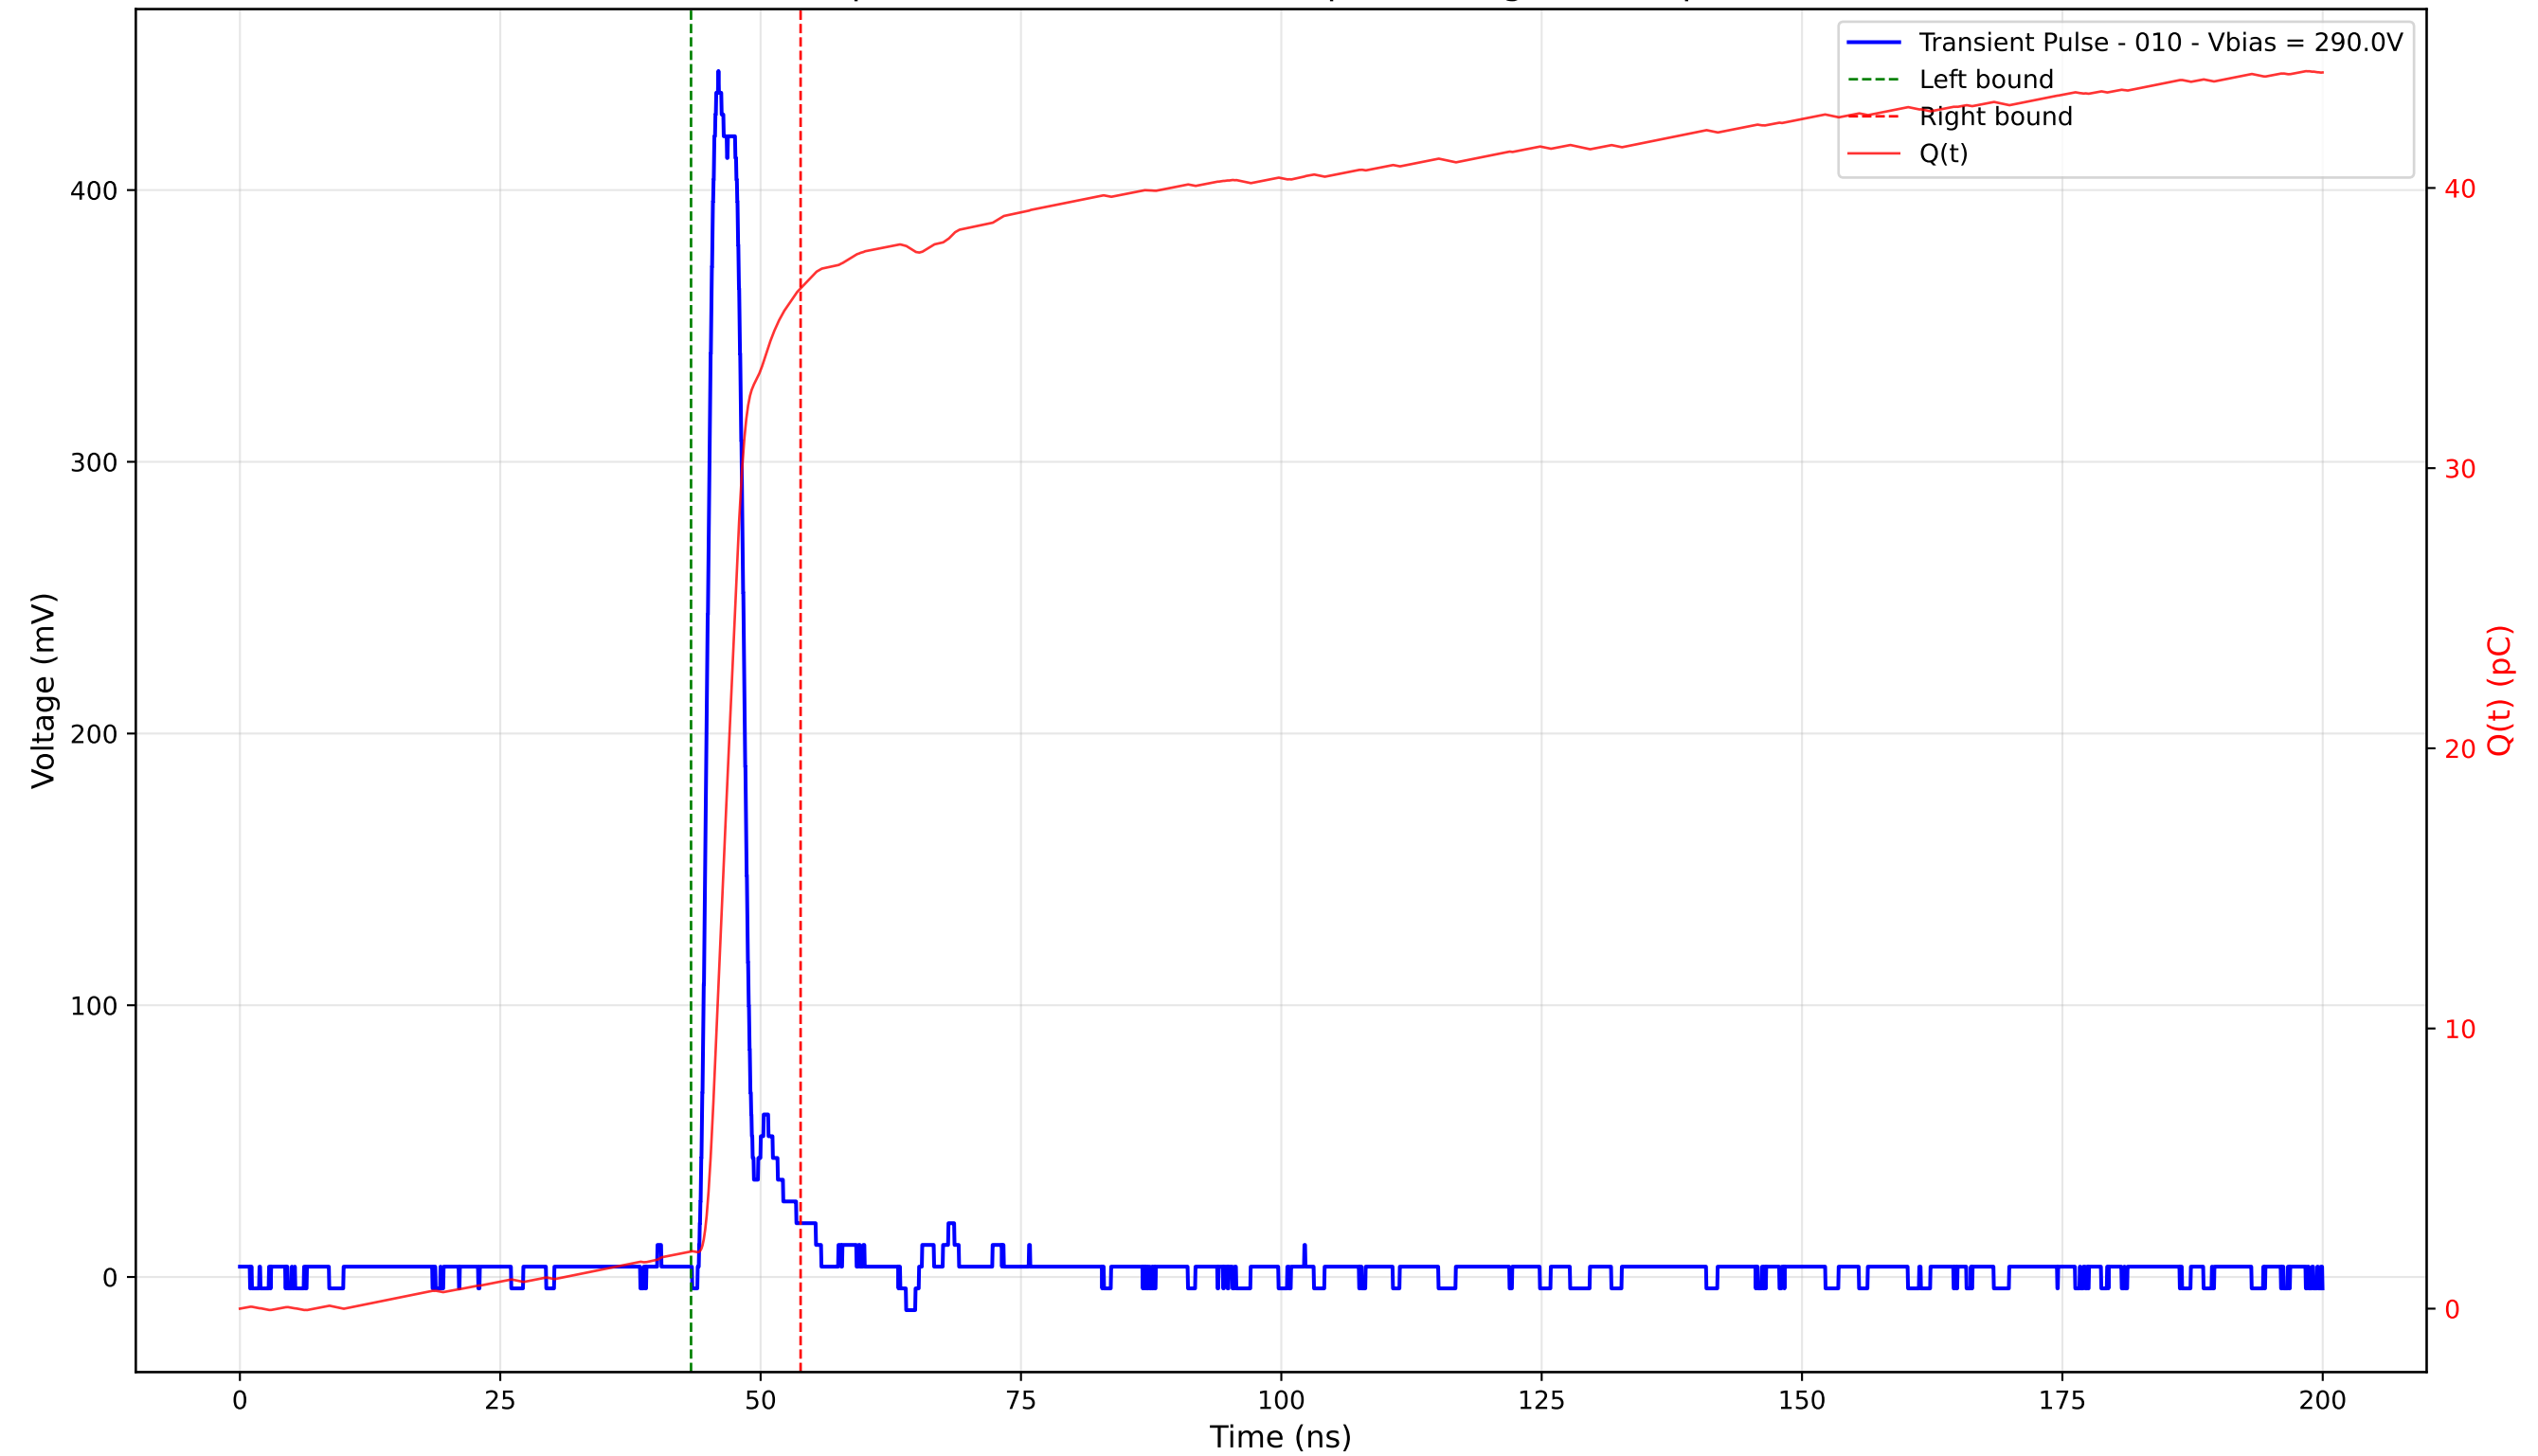


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 33.84 pC - Rise Time: 1.10 ns

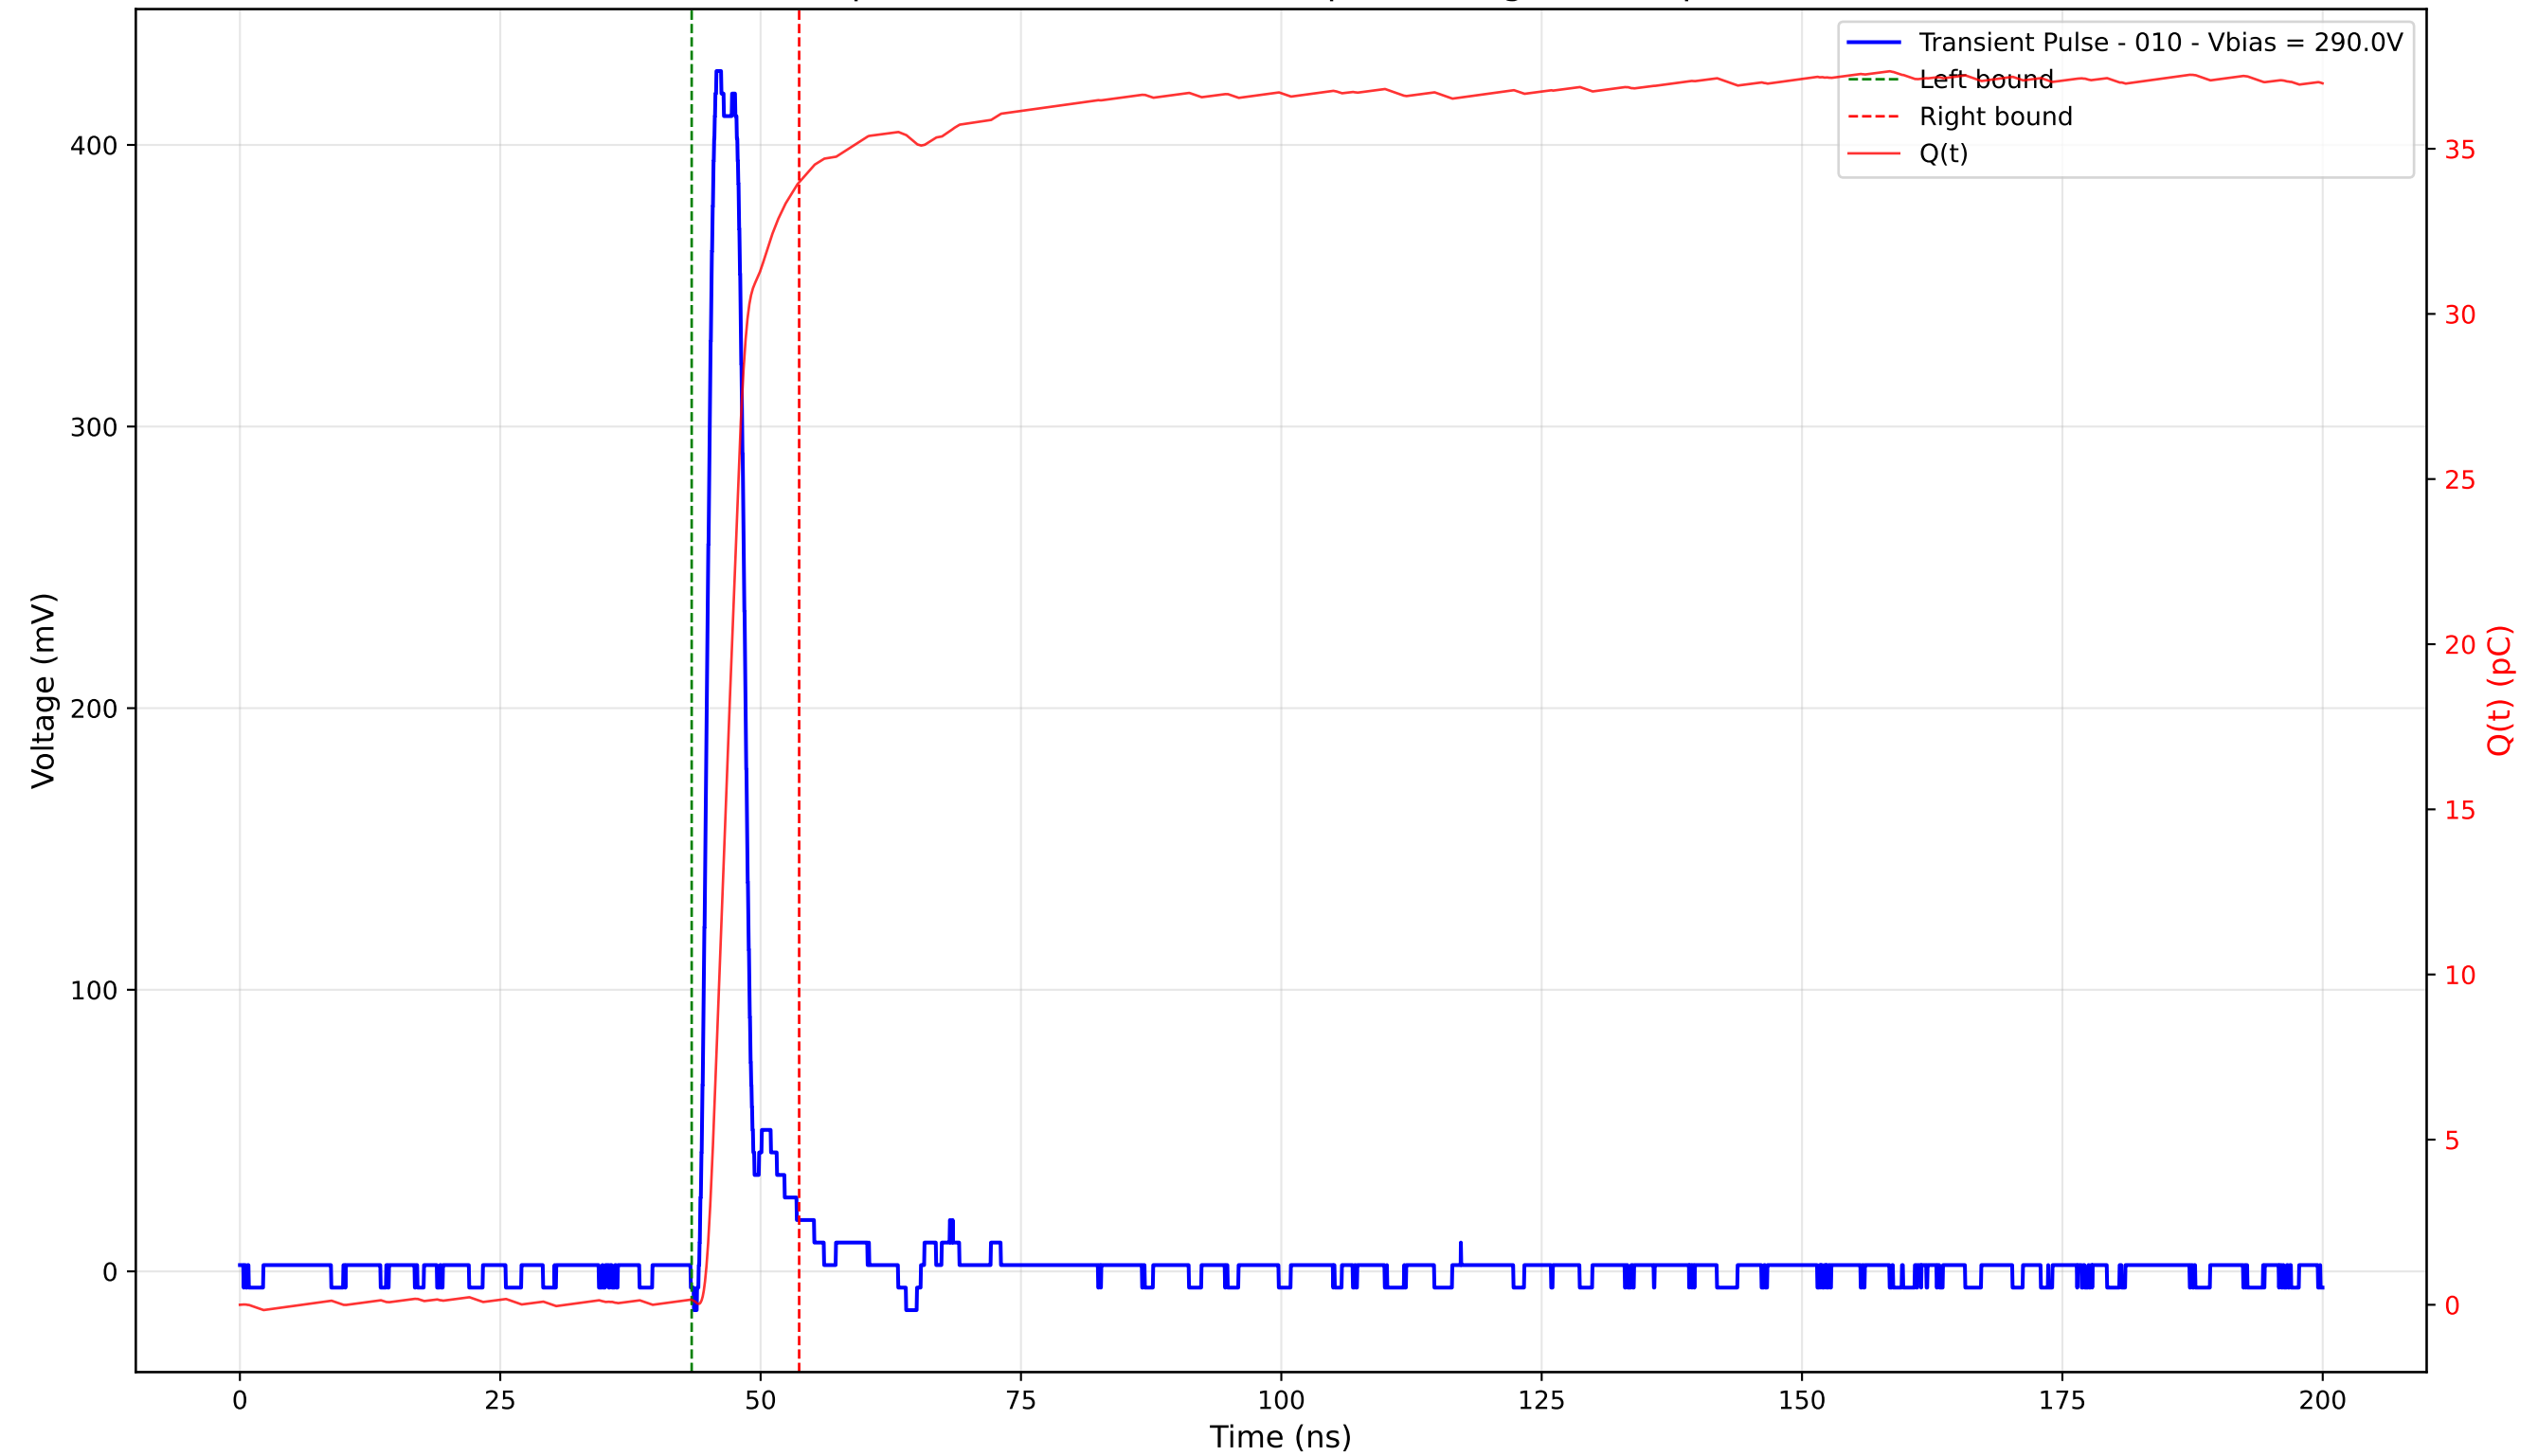


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 33.30 pC - Rise Time: 1.16 ns

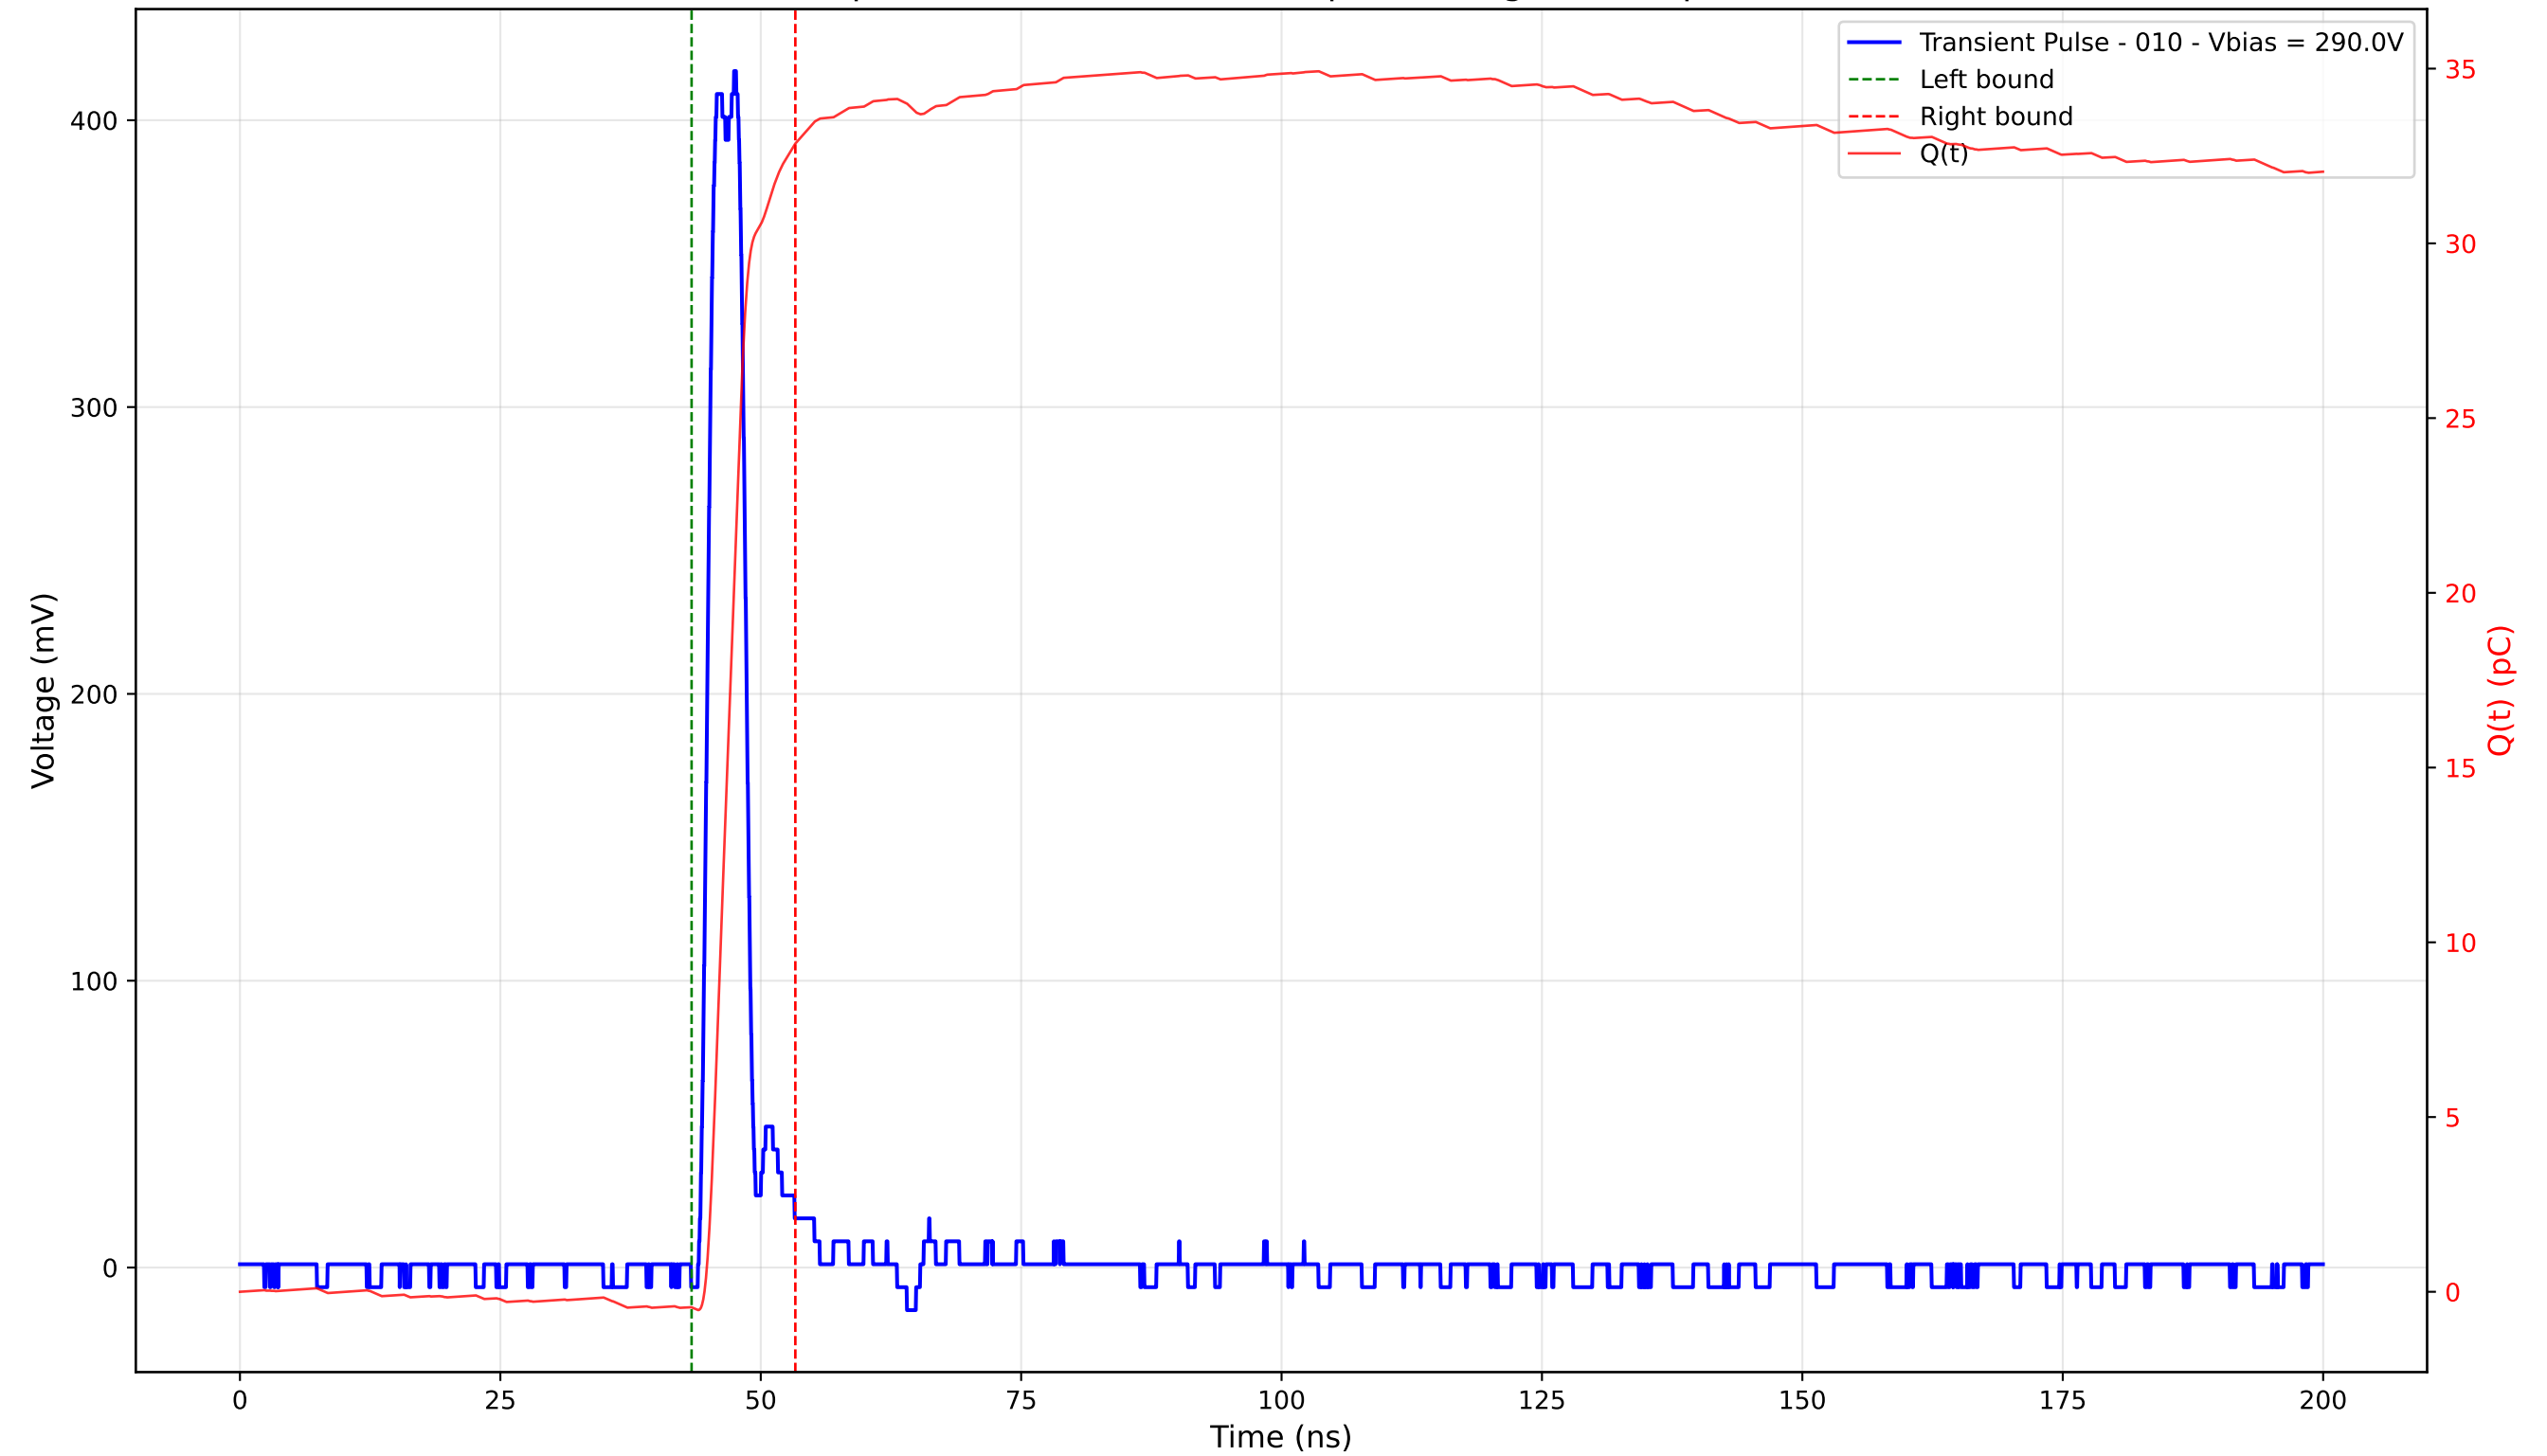


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 33.22 pC - Rise Time: 1.22 ns

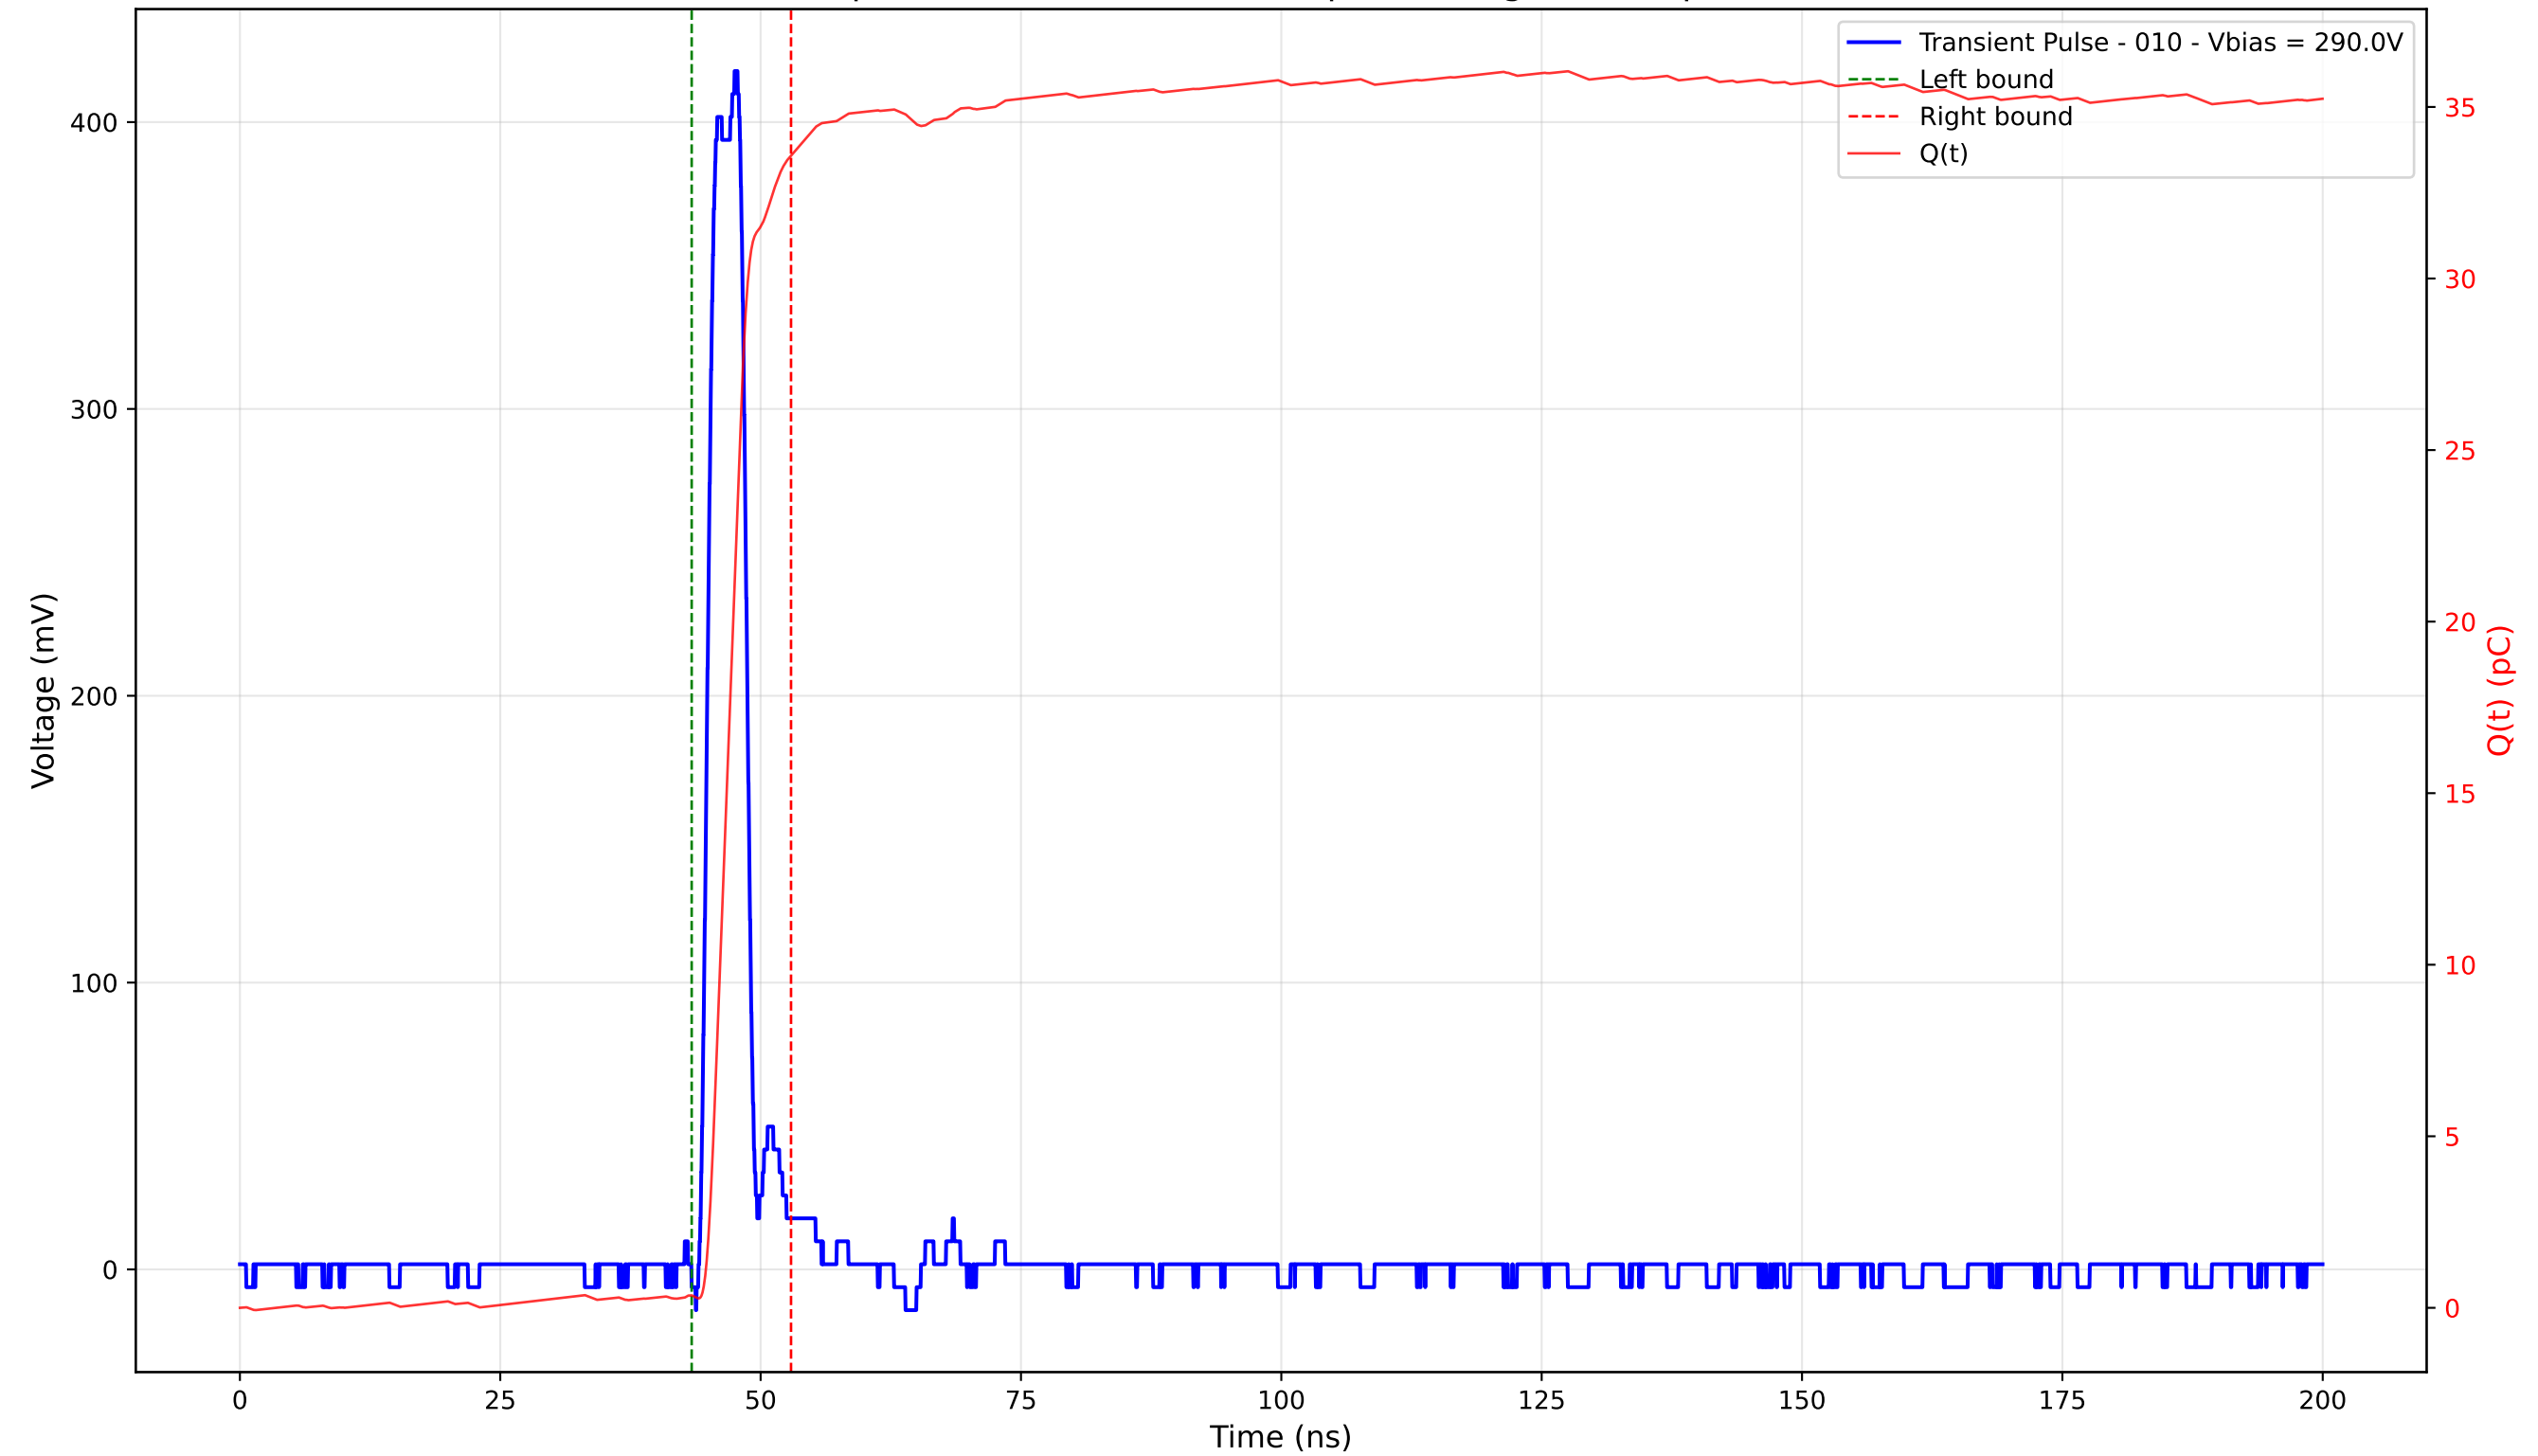


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 32.87 pC - Rise Time: 1.32 ns

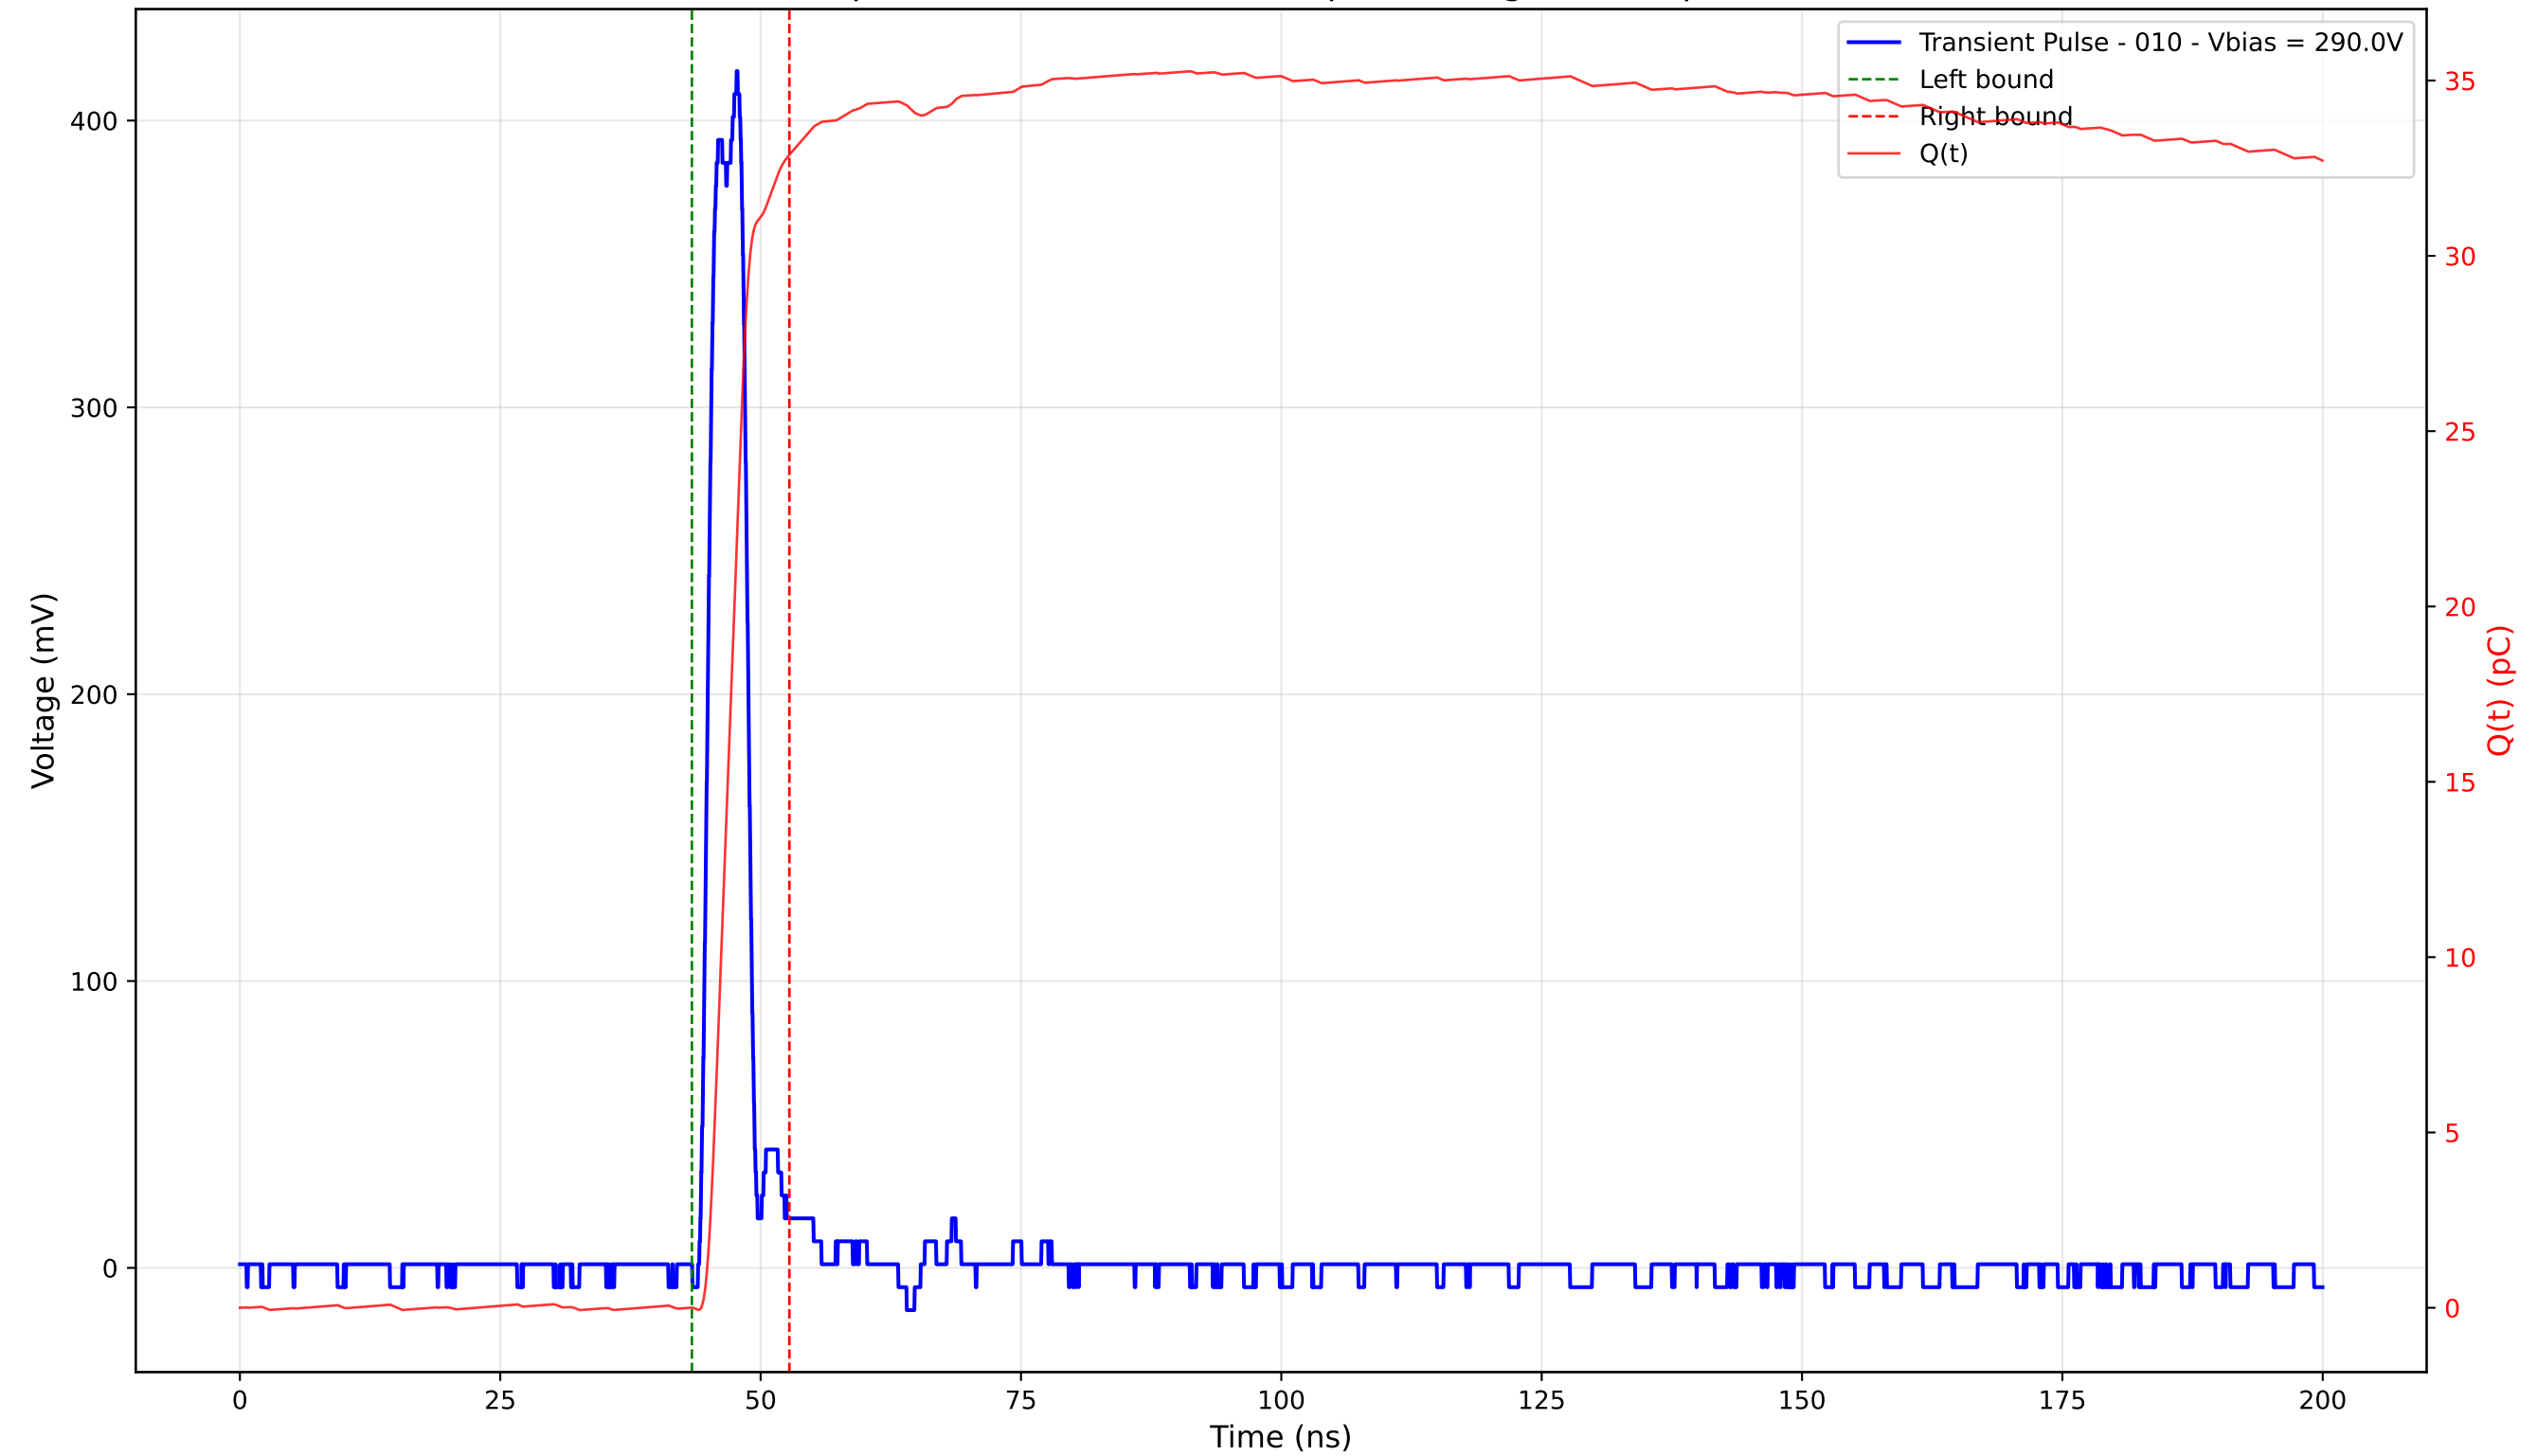


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 32.92 pC - Rise Time: 1.40 ns

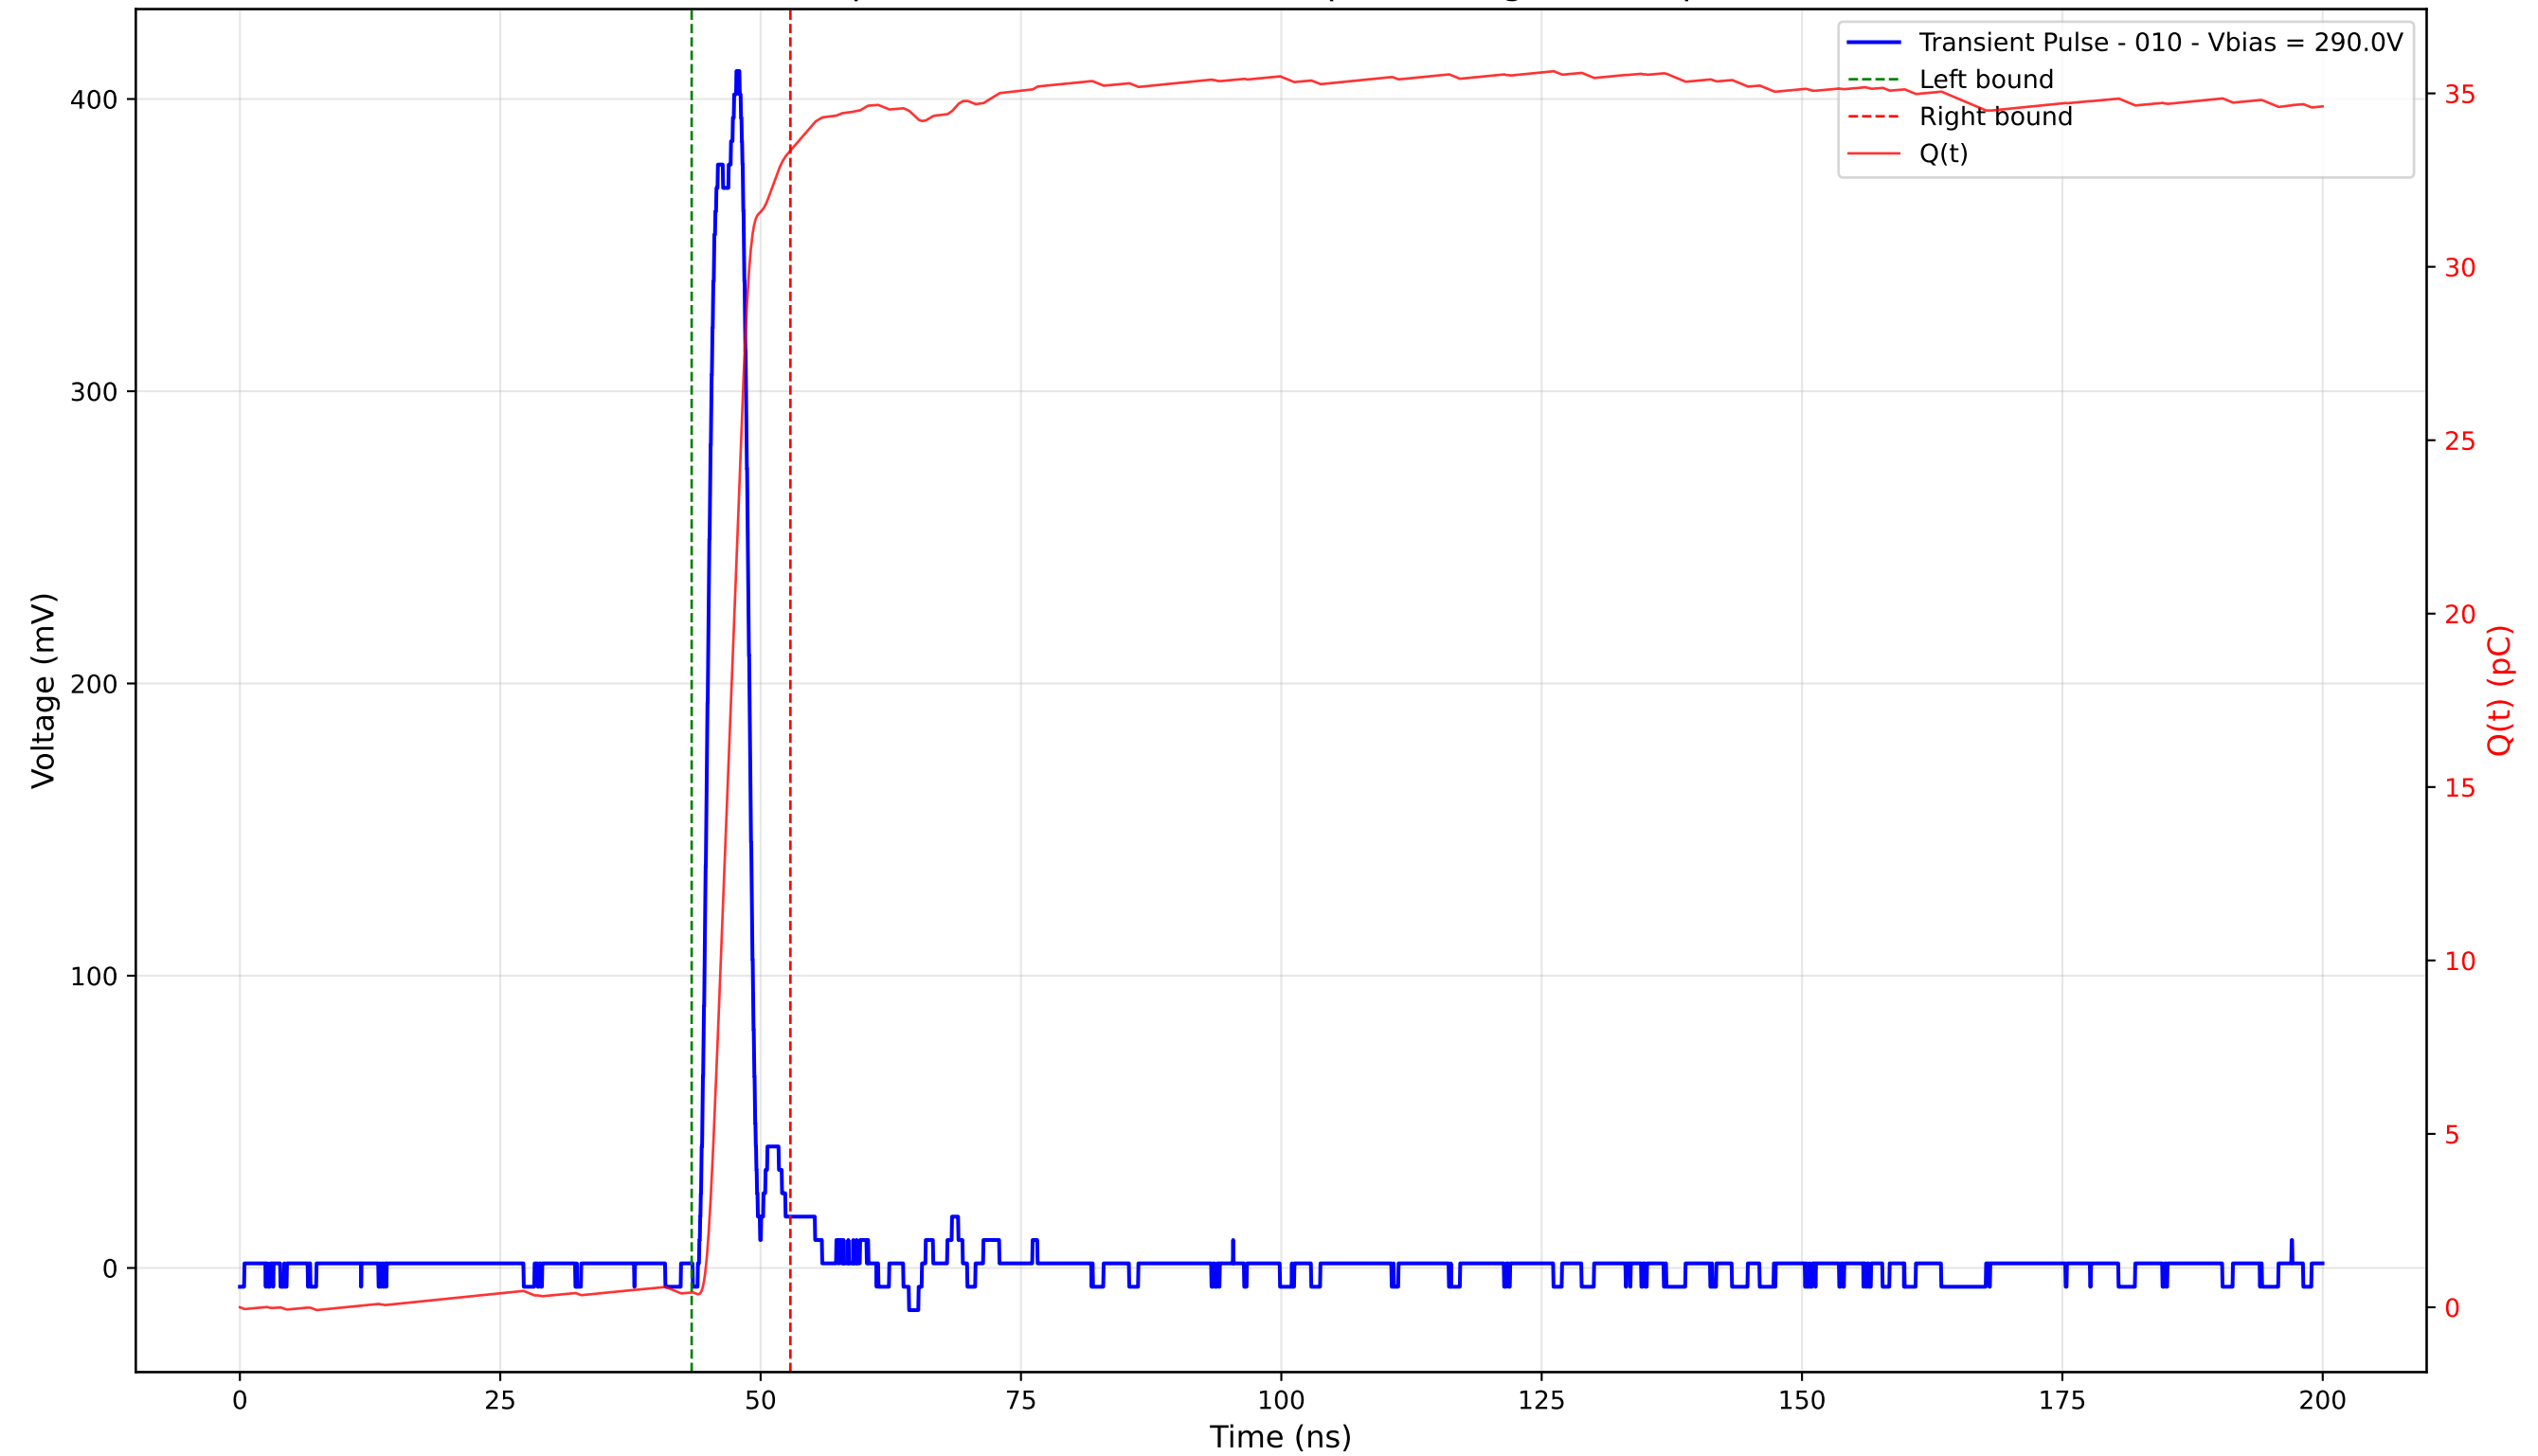


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 32.61 pC - Rise Time: 1.56 ns

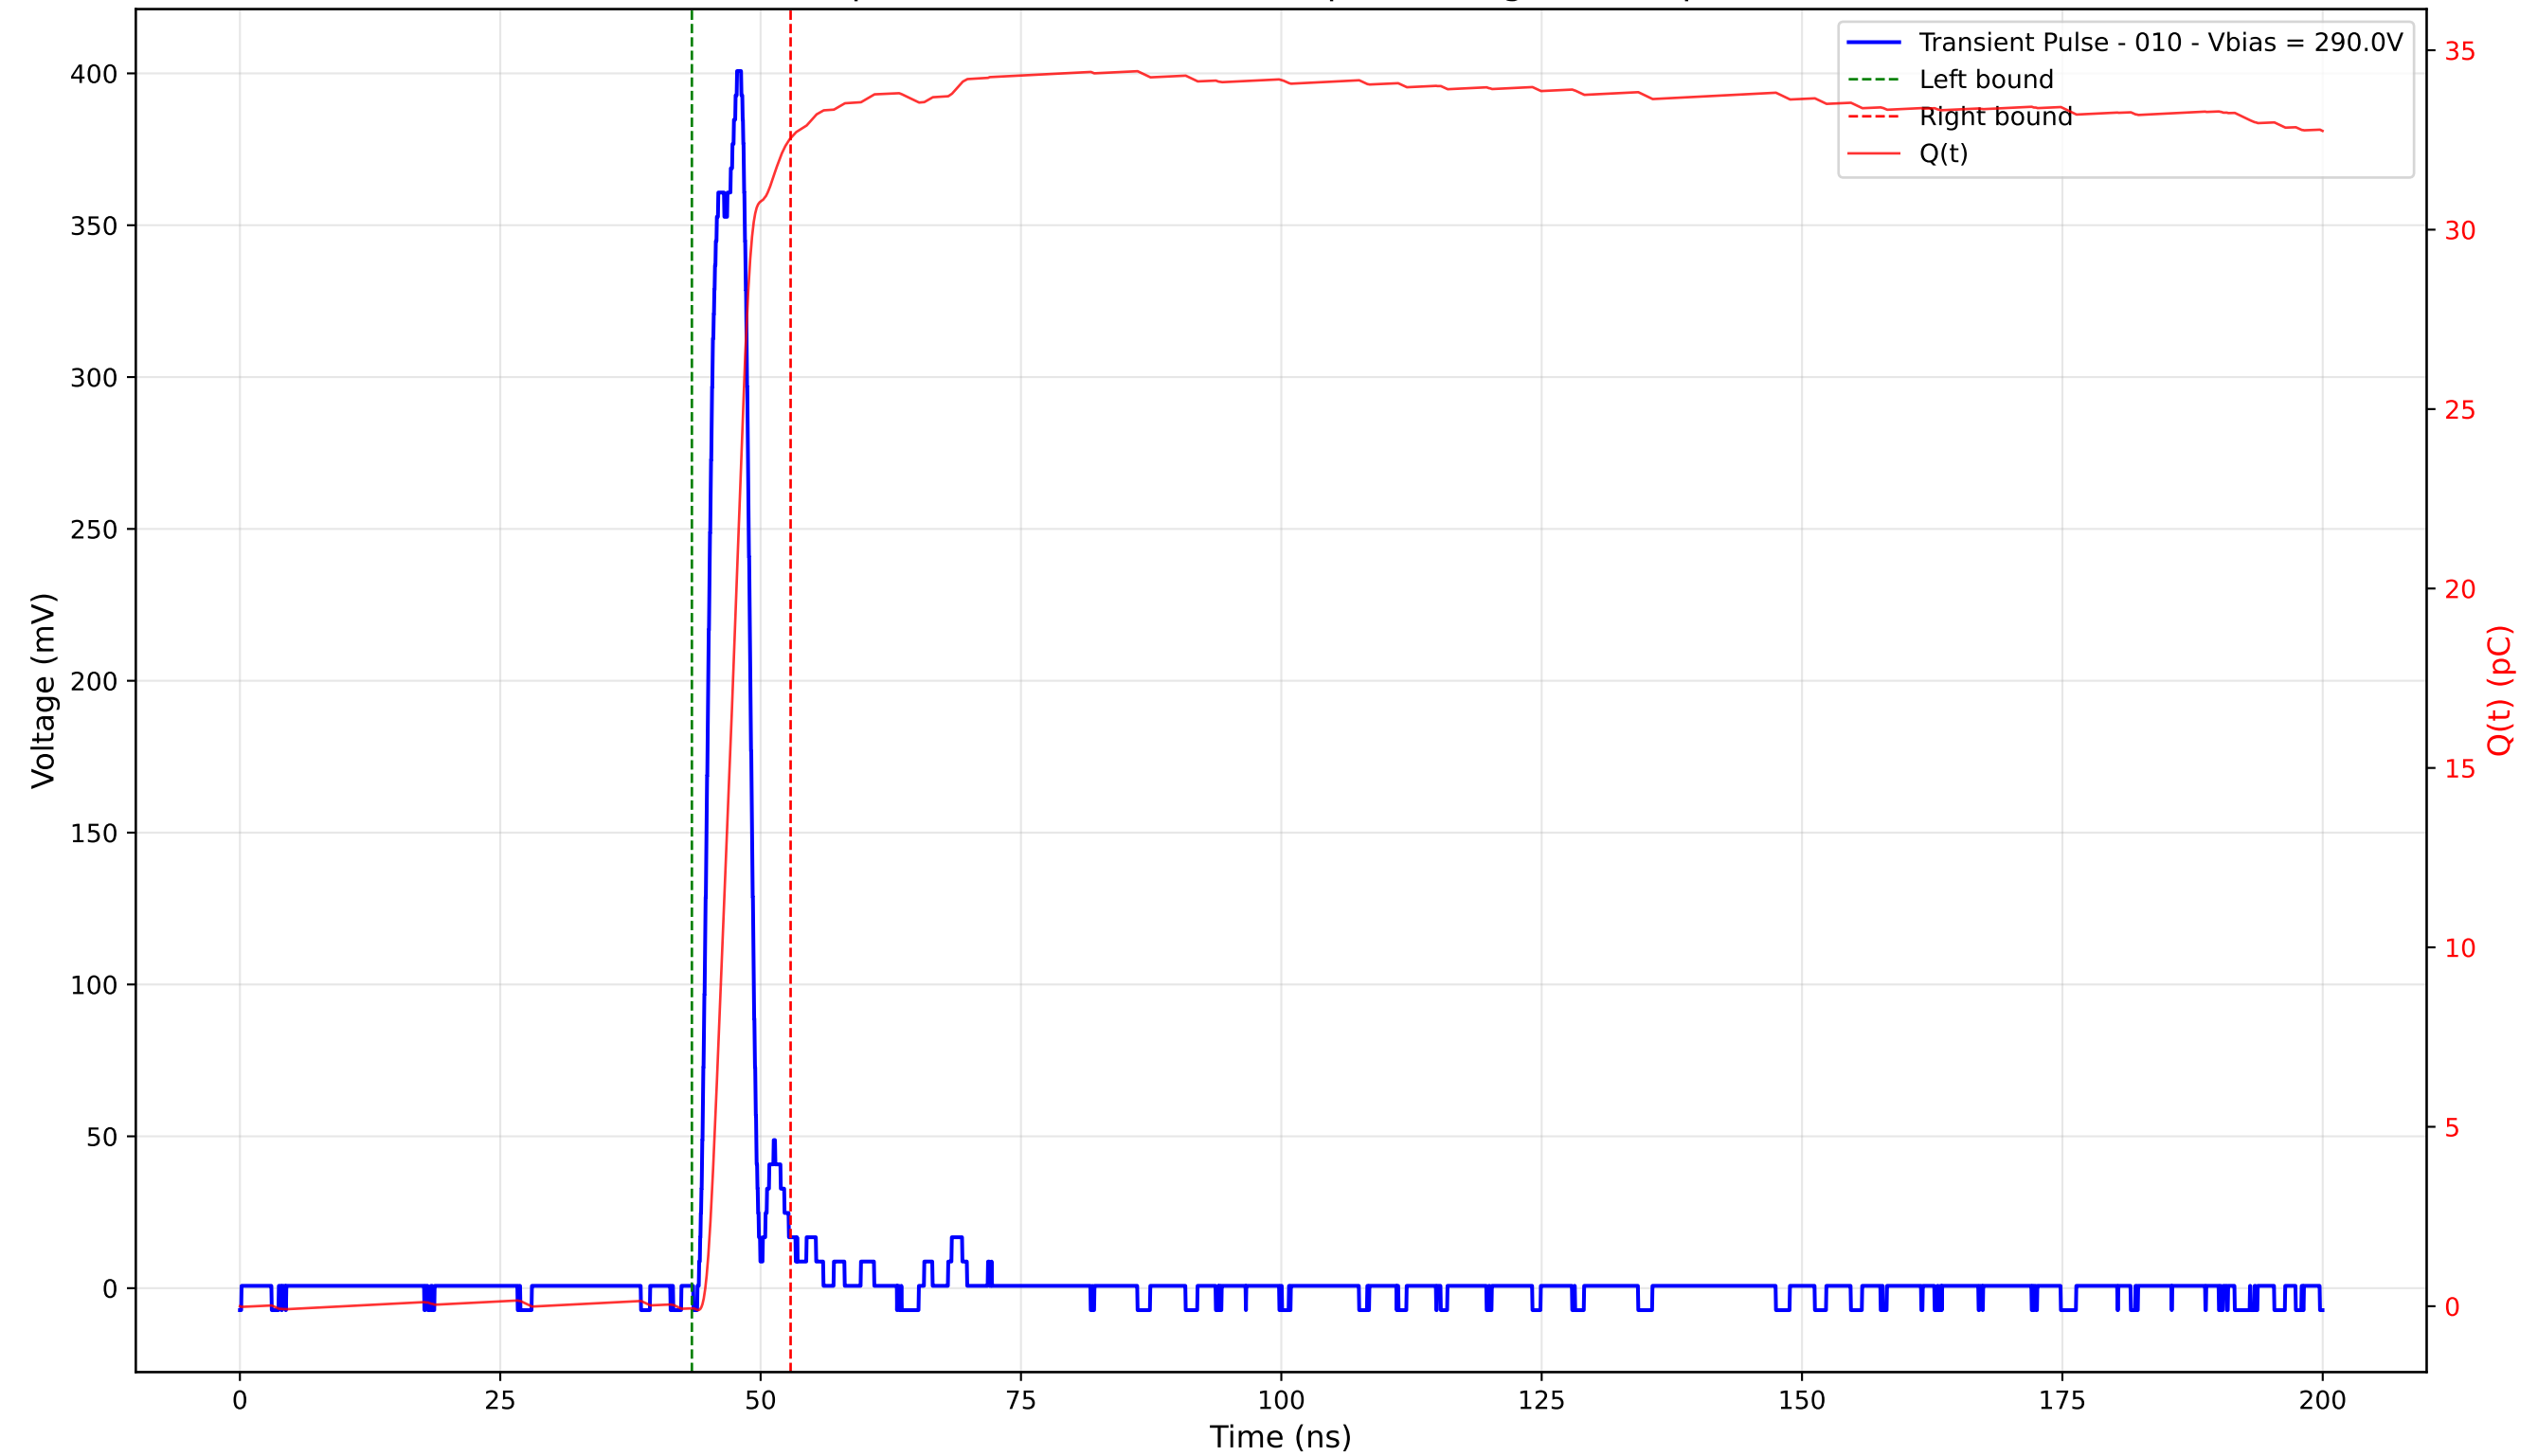


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 33.20 pC - Rise Time: 2.75 ns

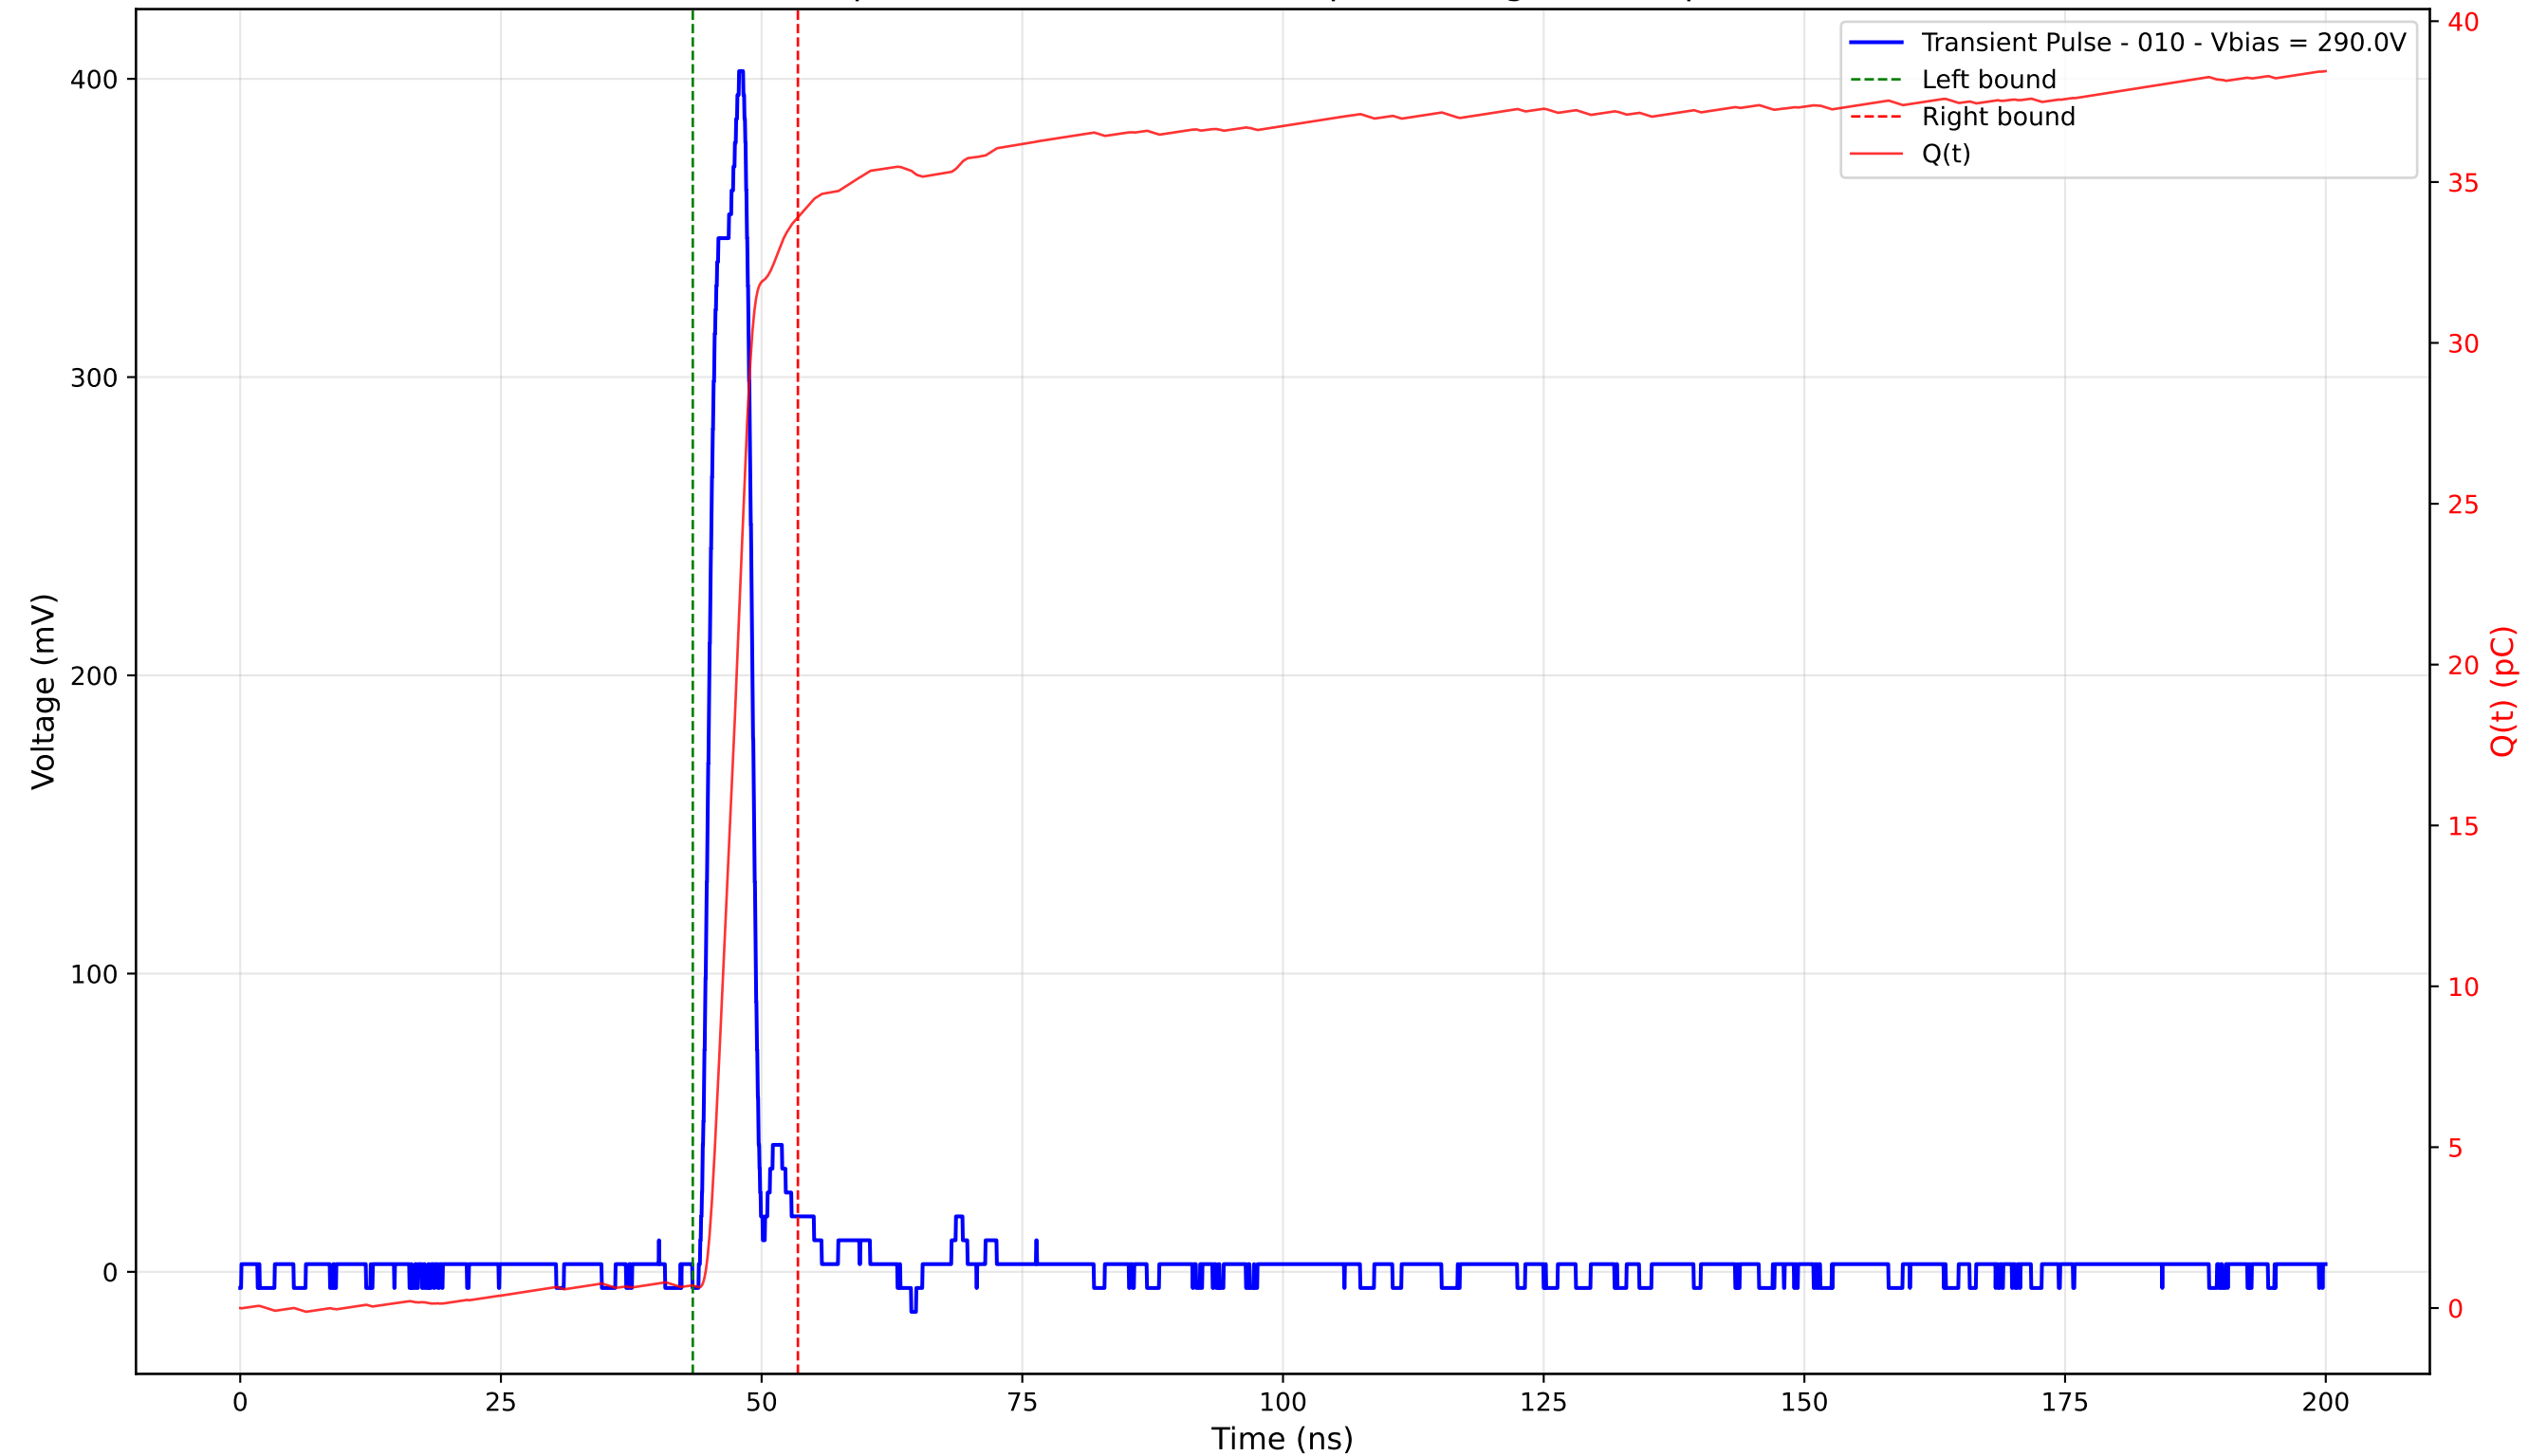


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 32.26 pC - Rise Time: 3.03 ns

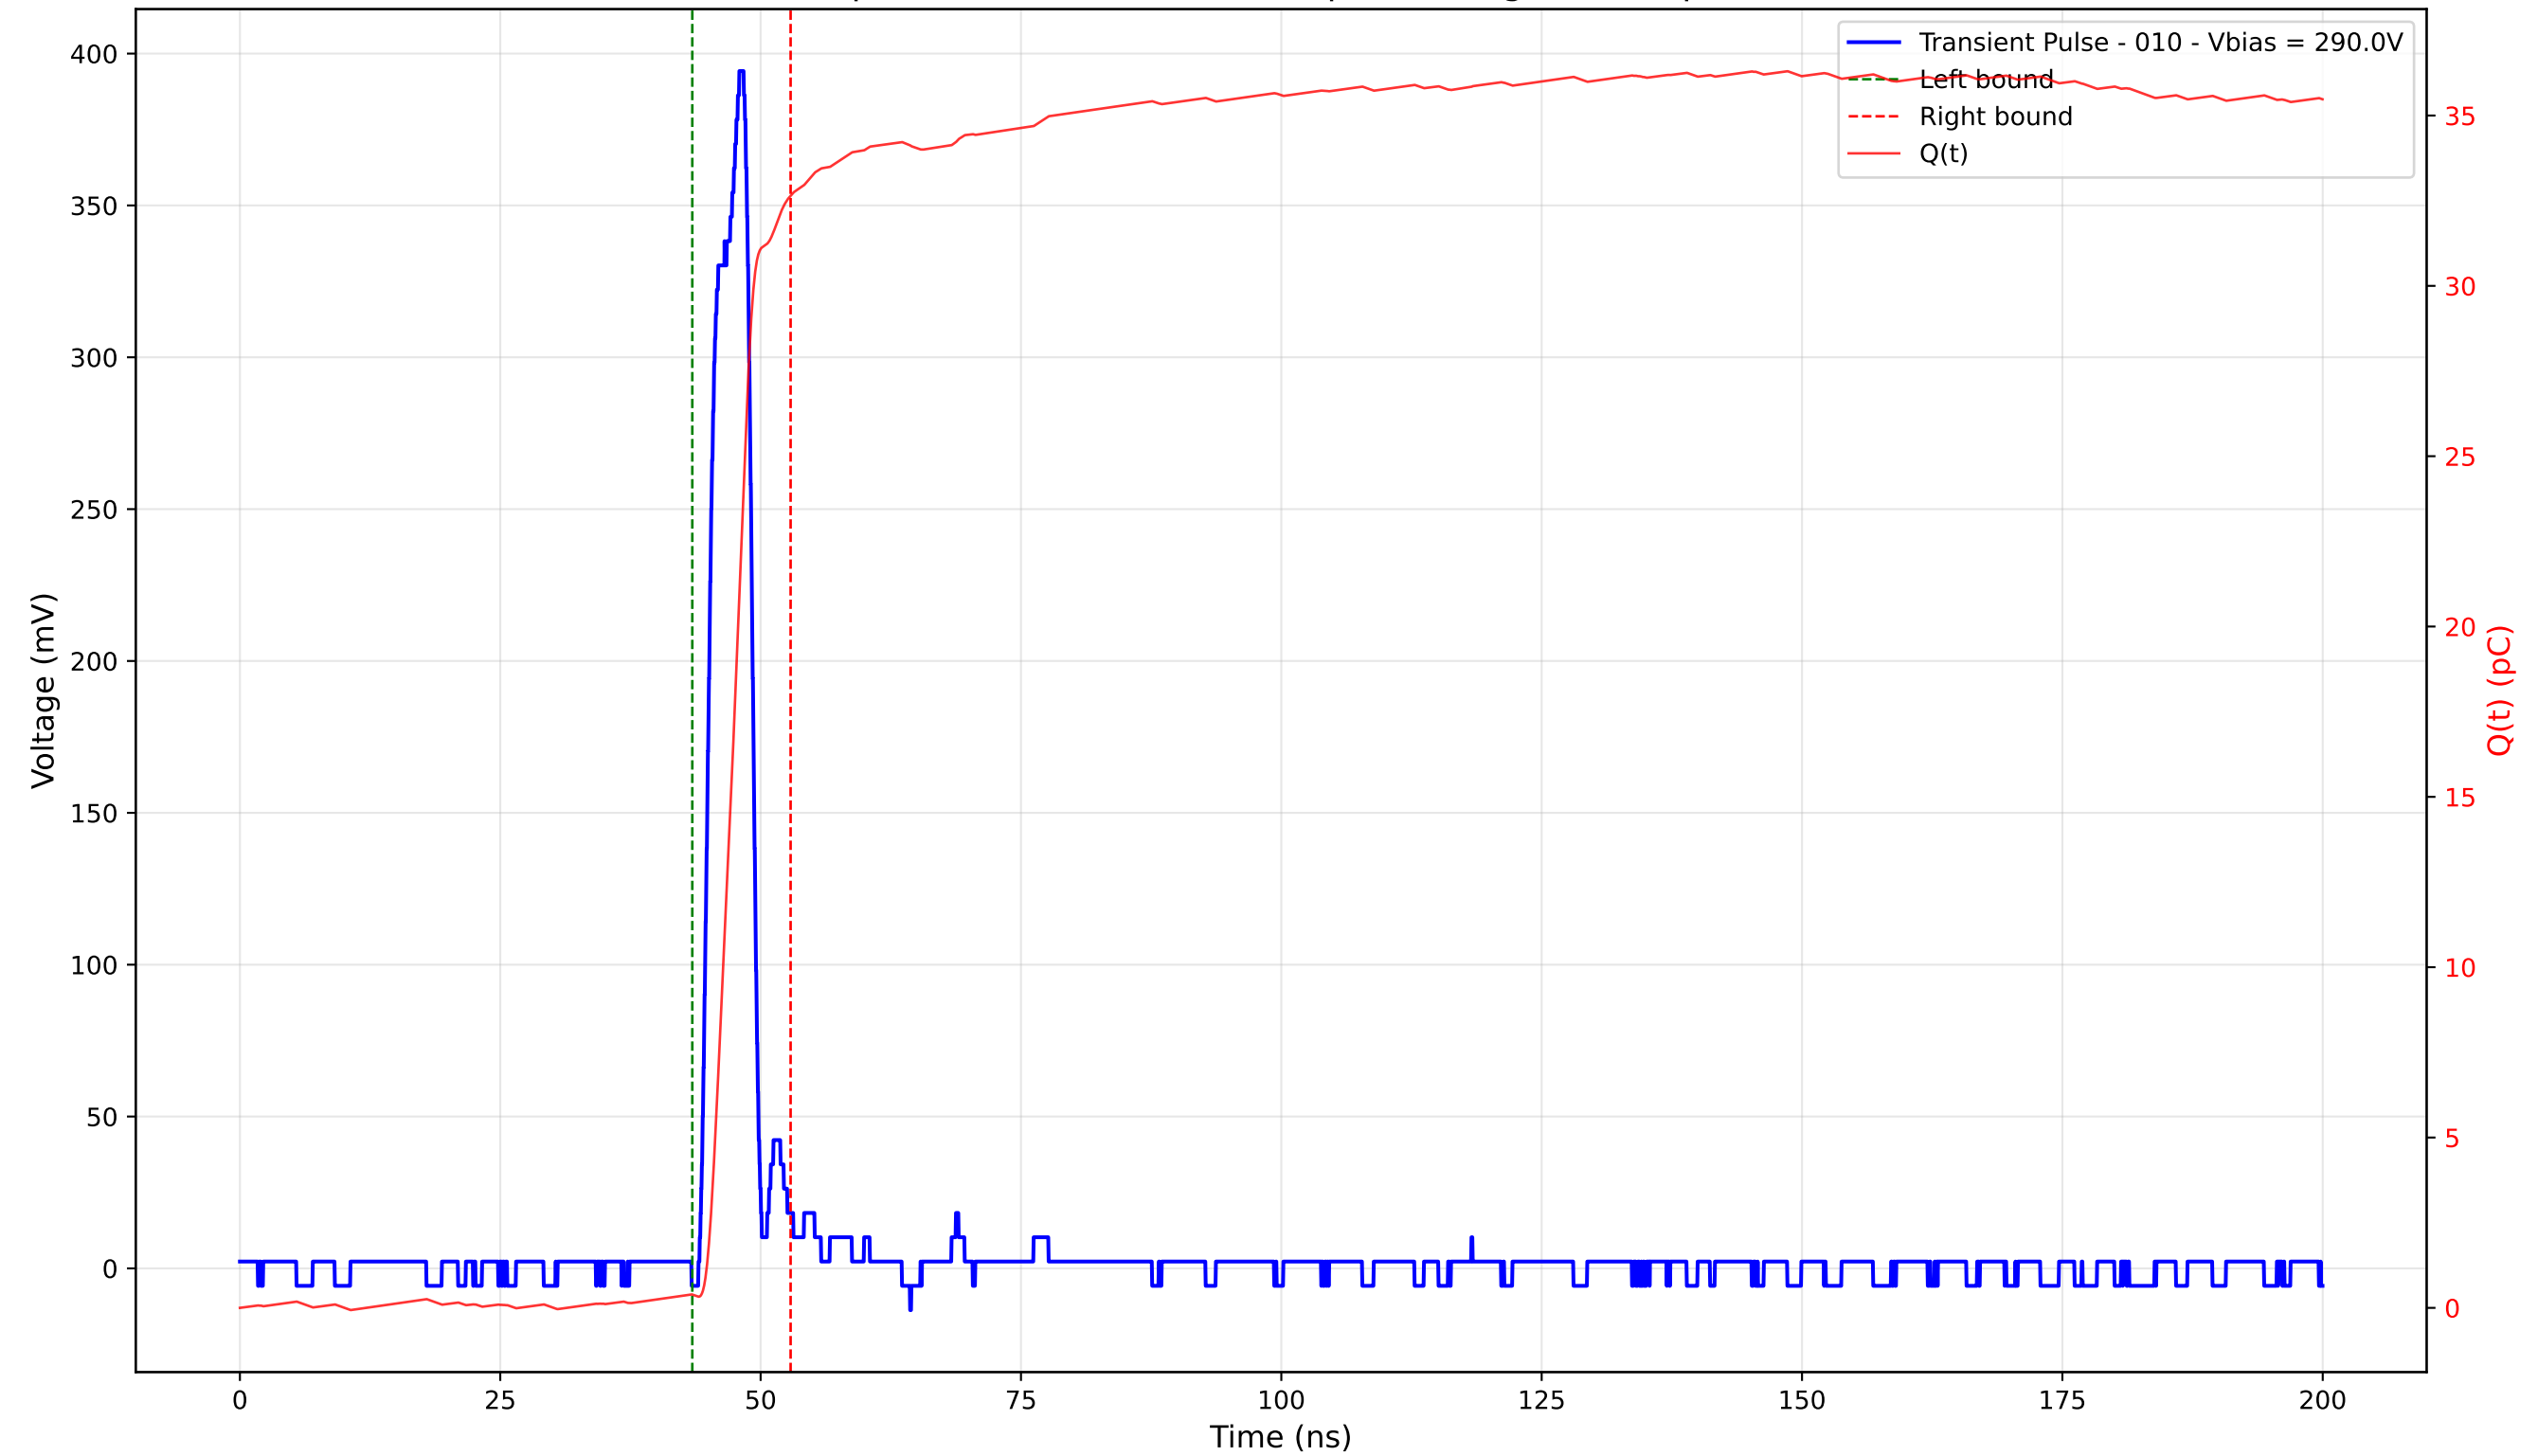


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 32.32 pC - Rise Time: 3.18 ns

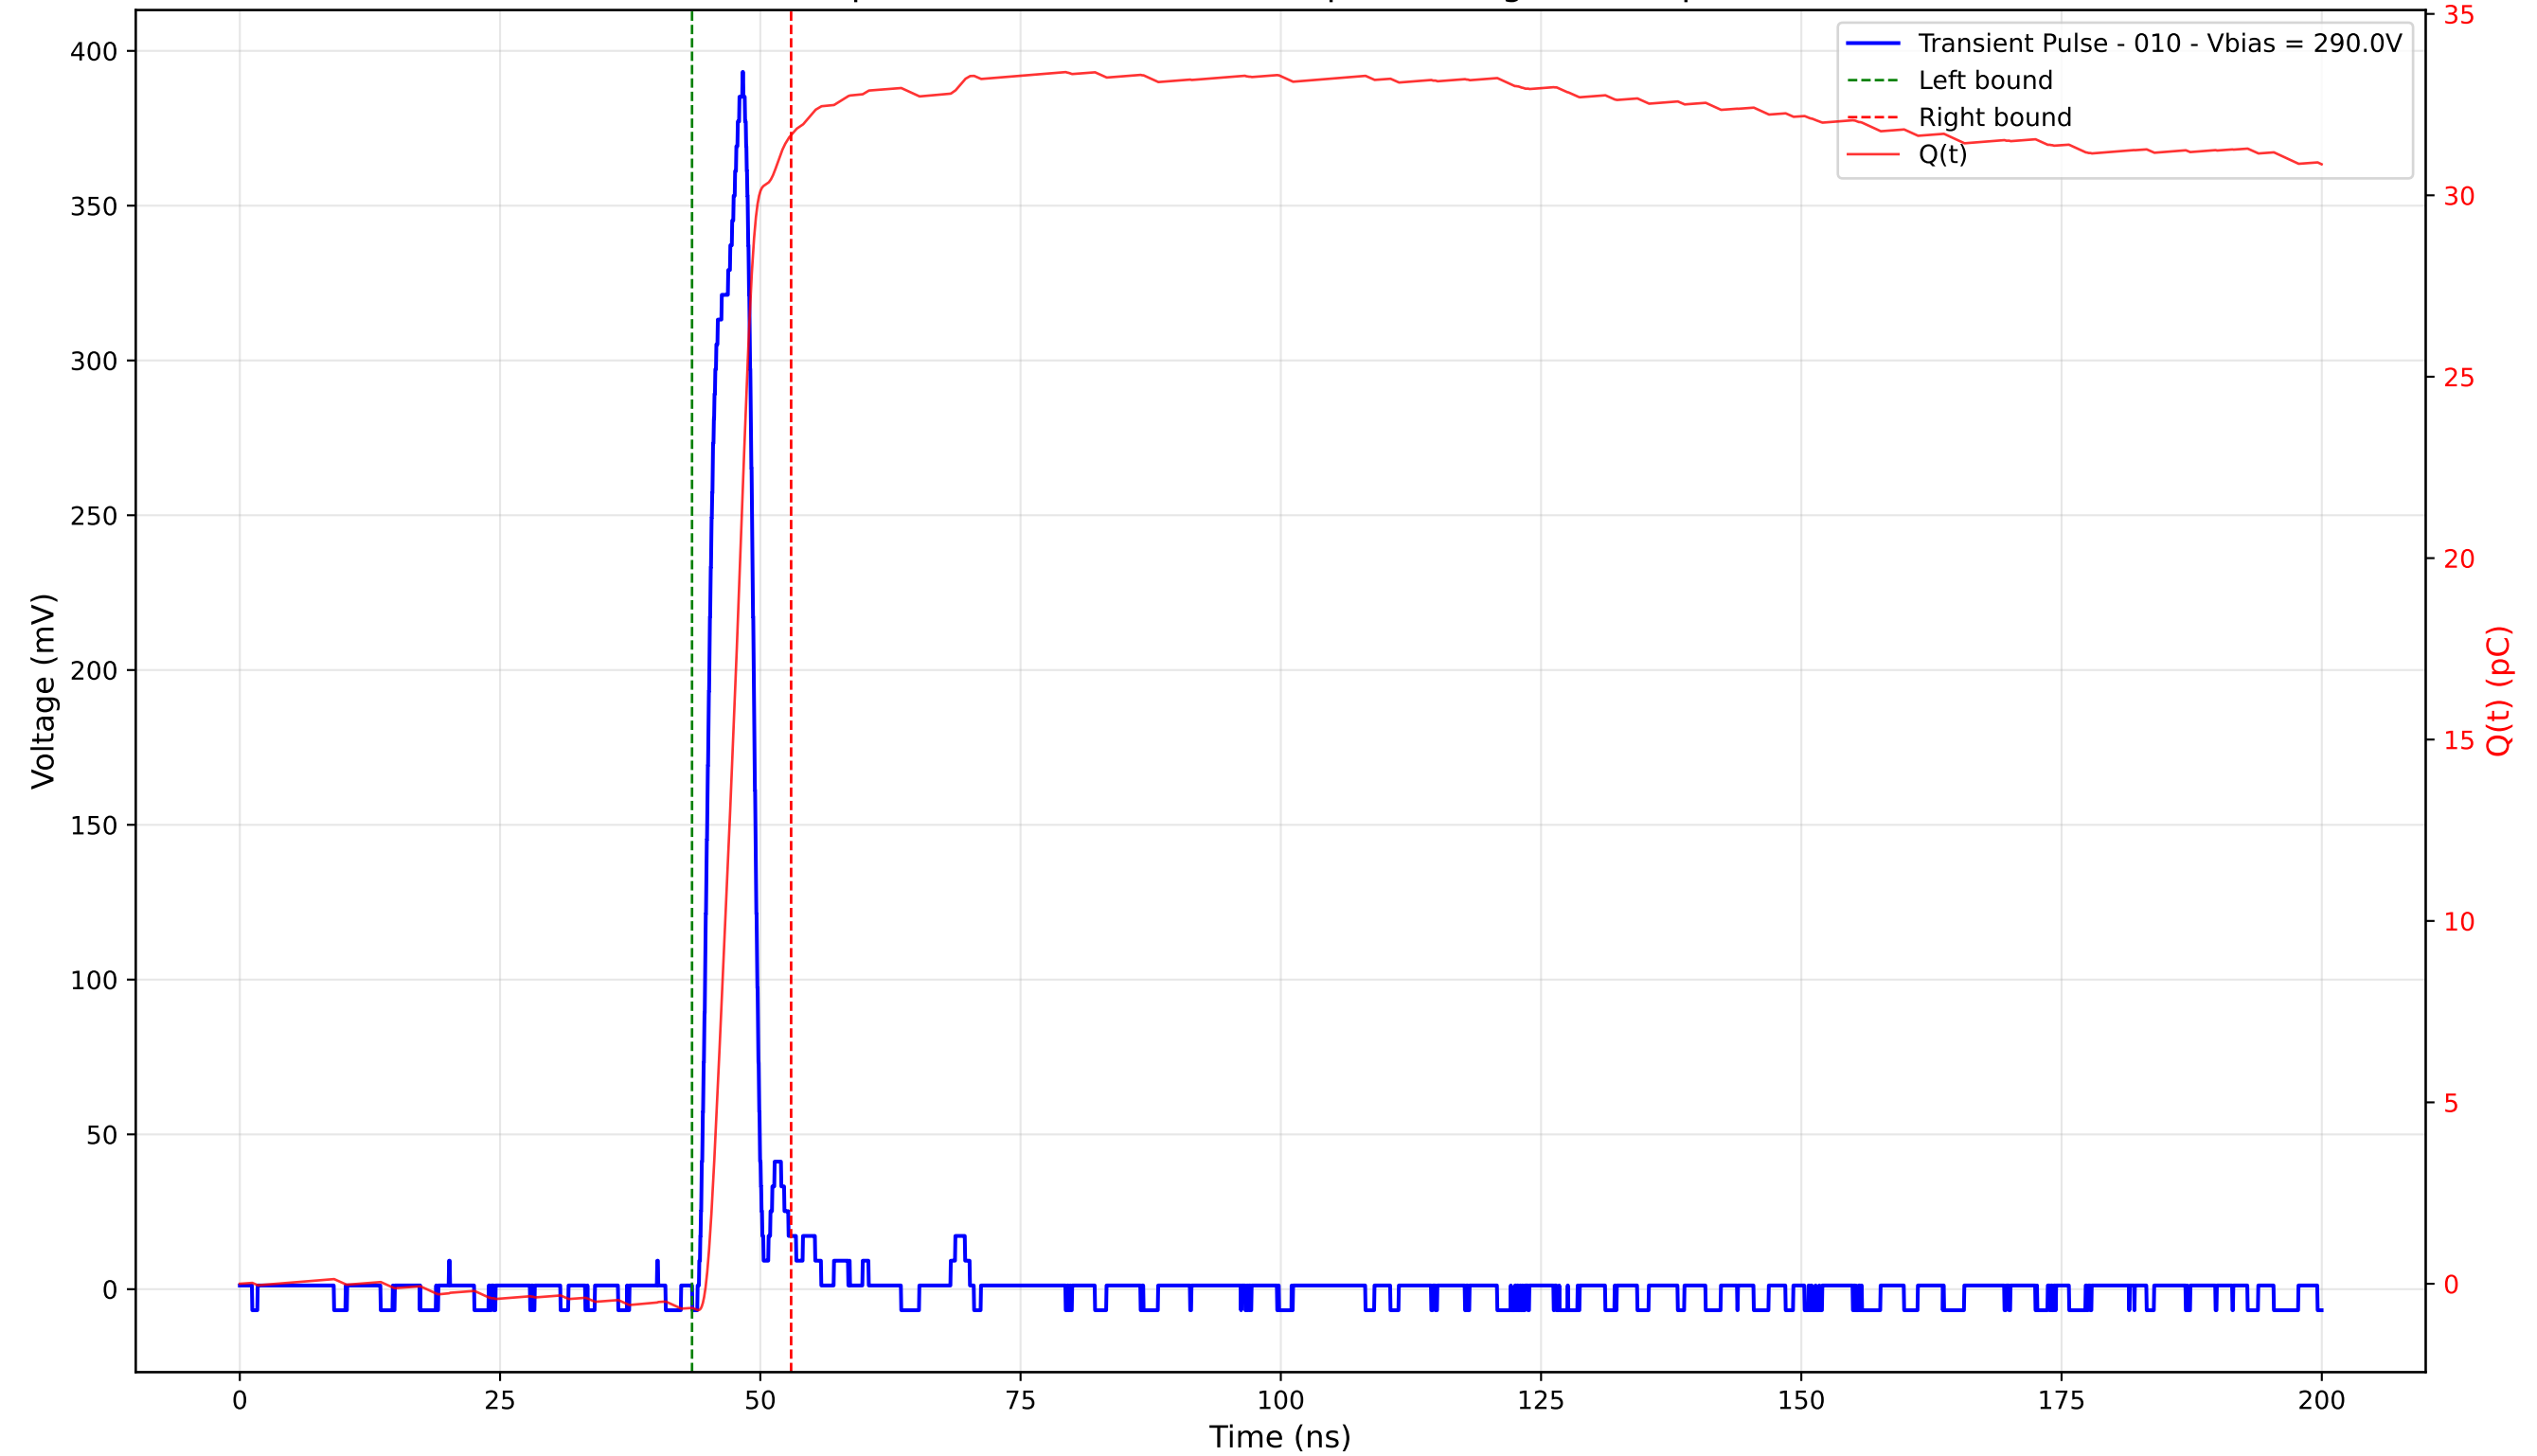


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 32.21 pC - Rise Time: 3.13 ns

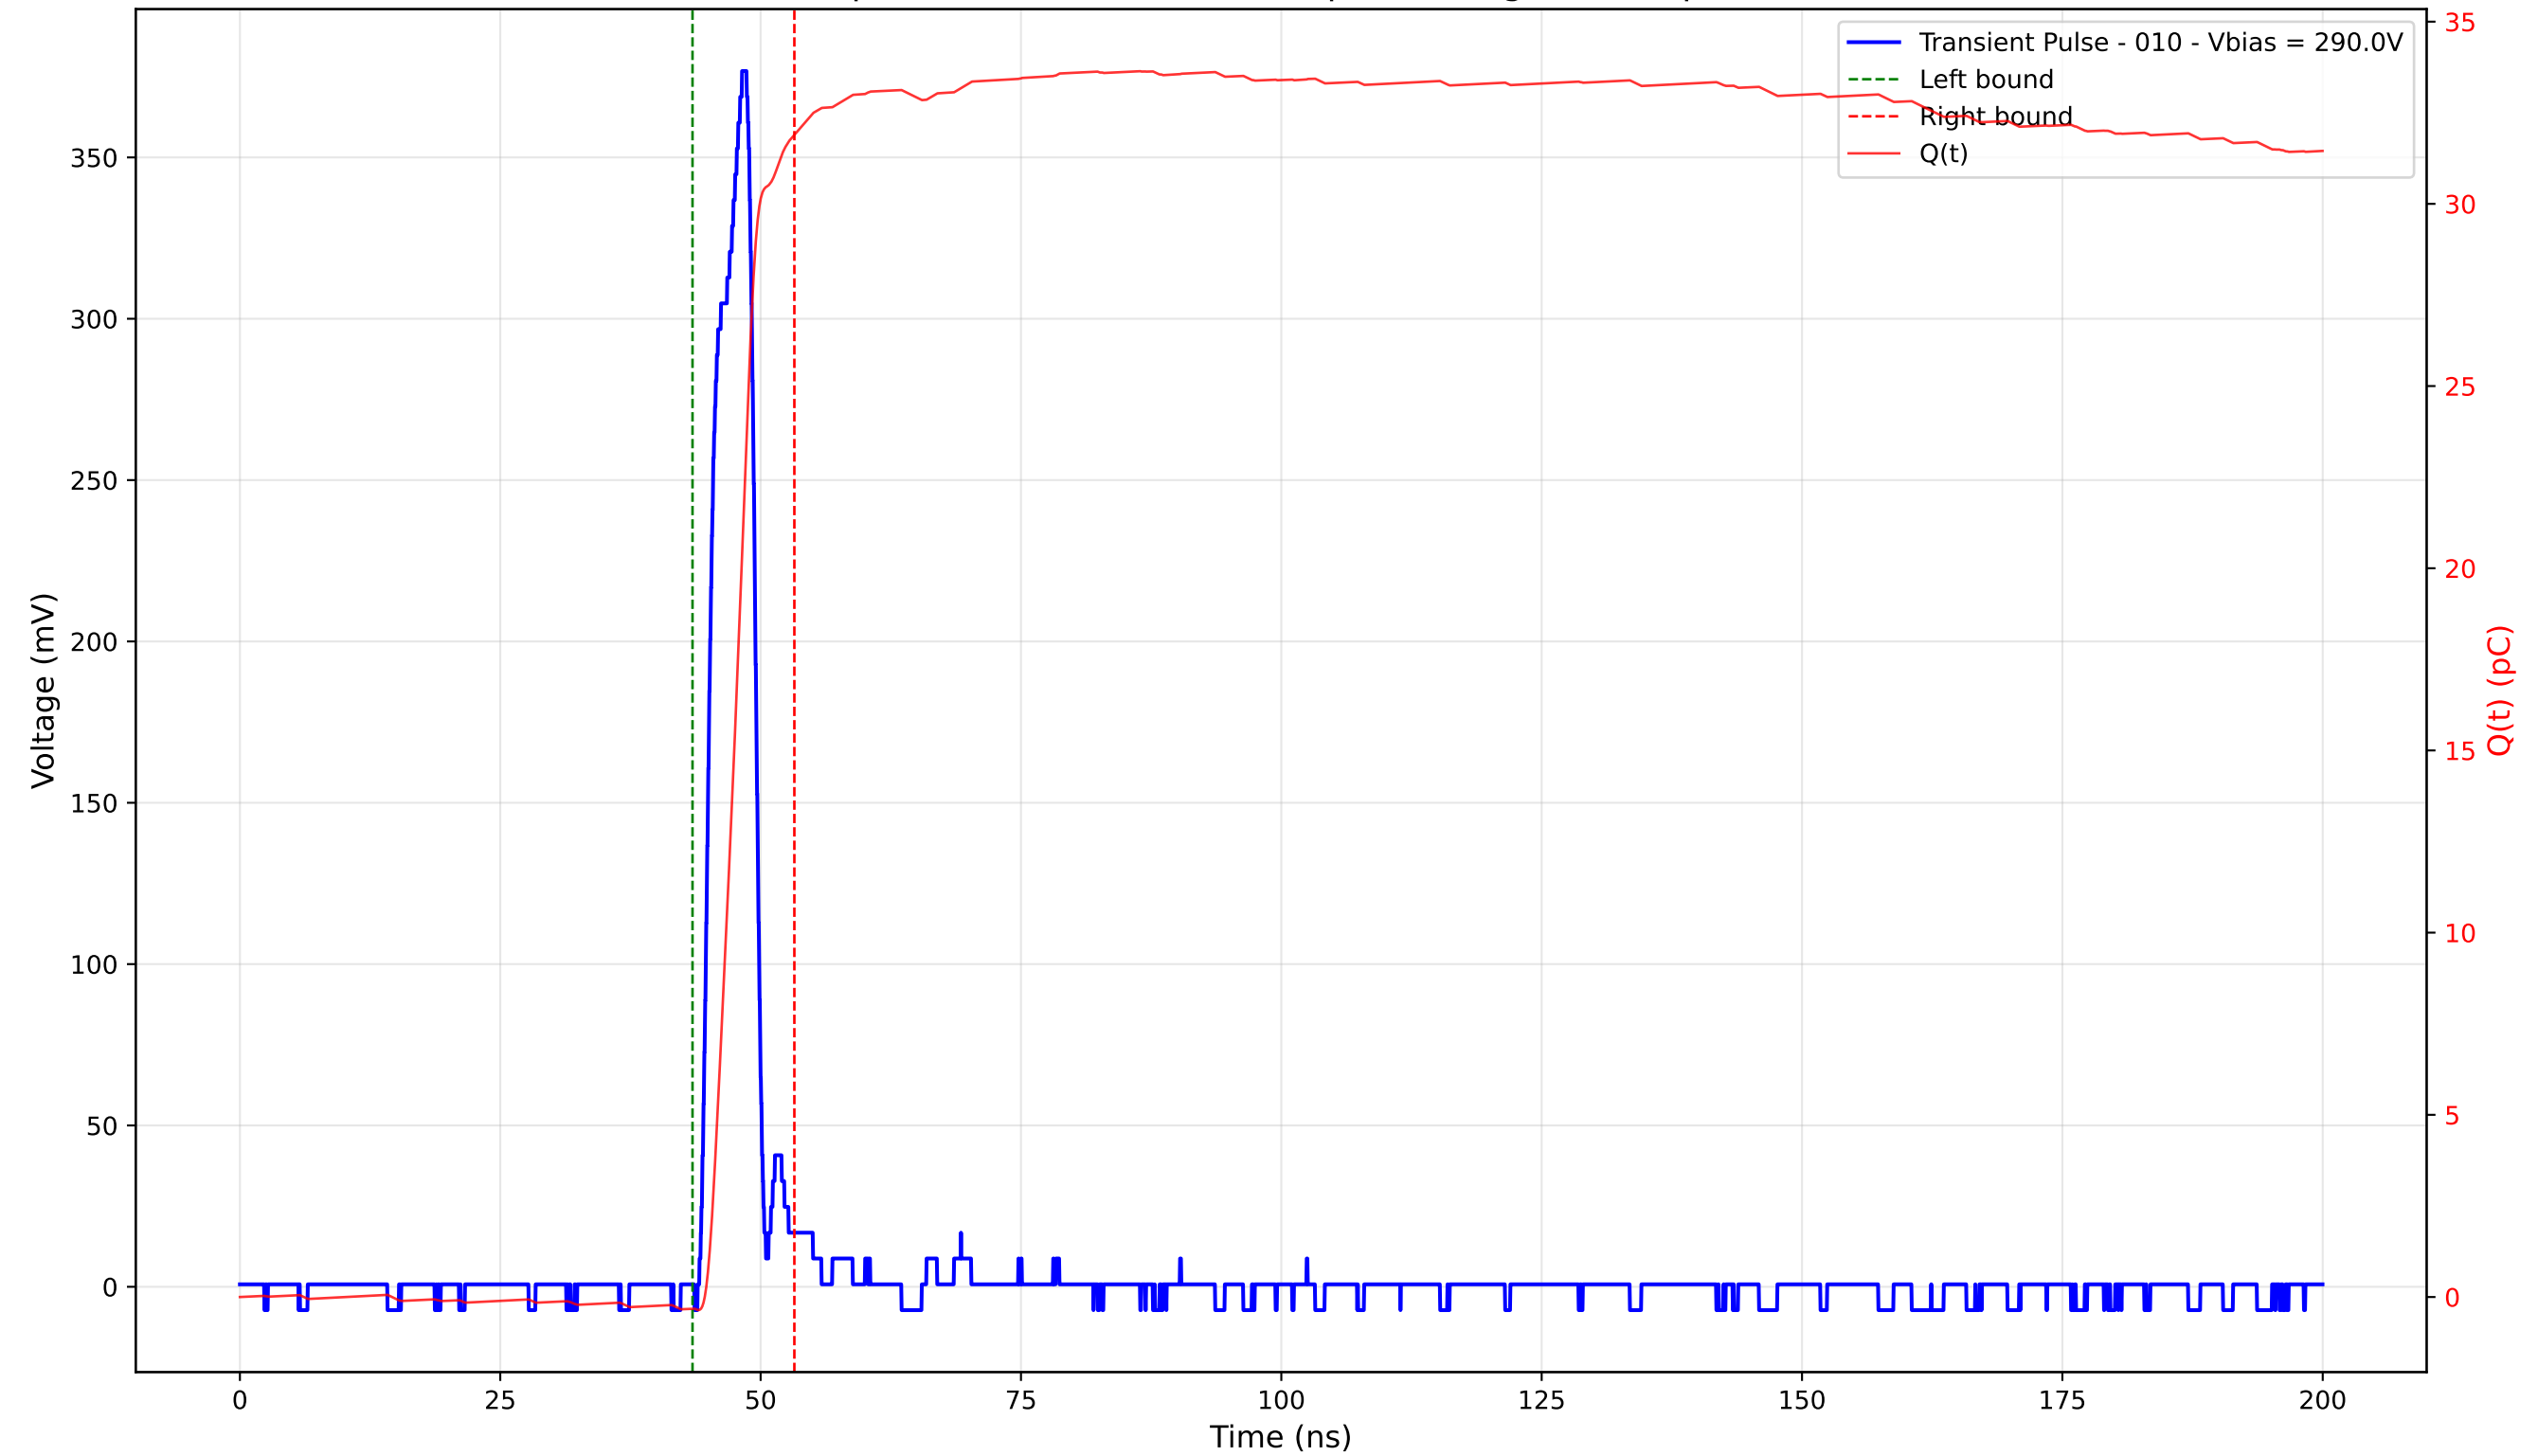


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 32.49 pC - Rise Time: 3.25 ns

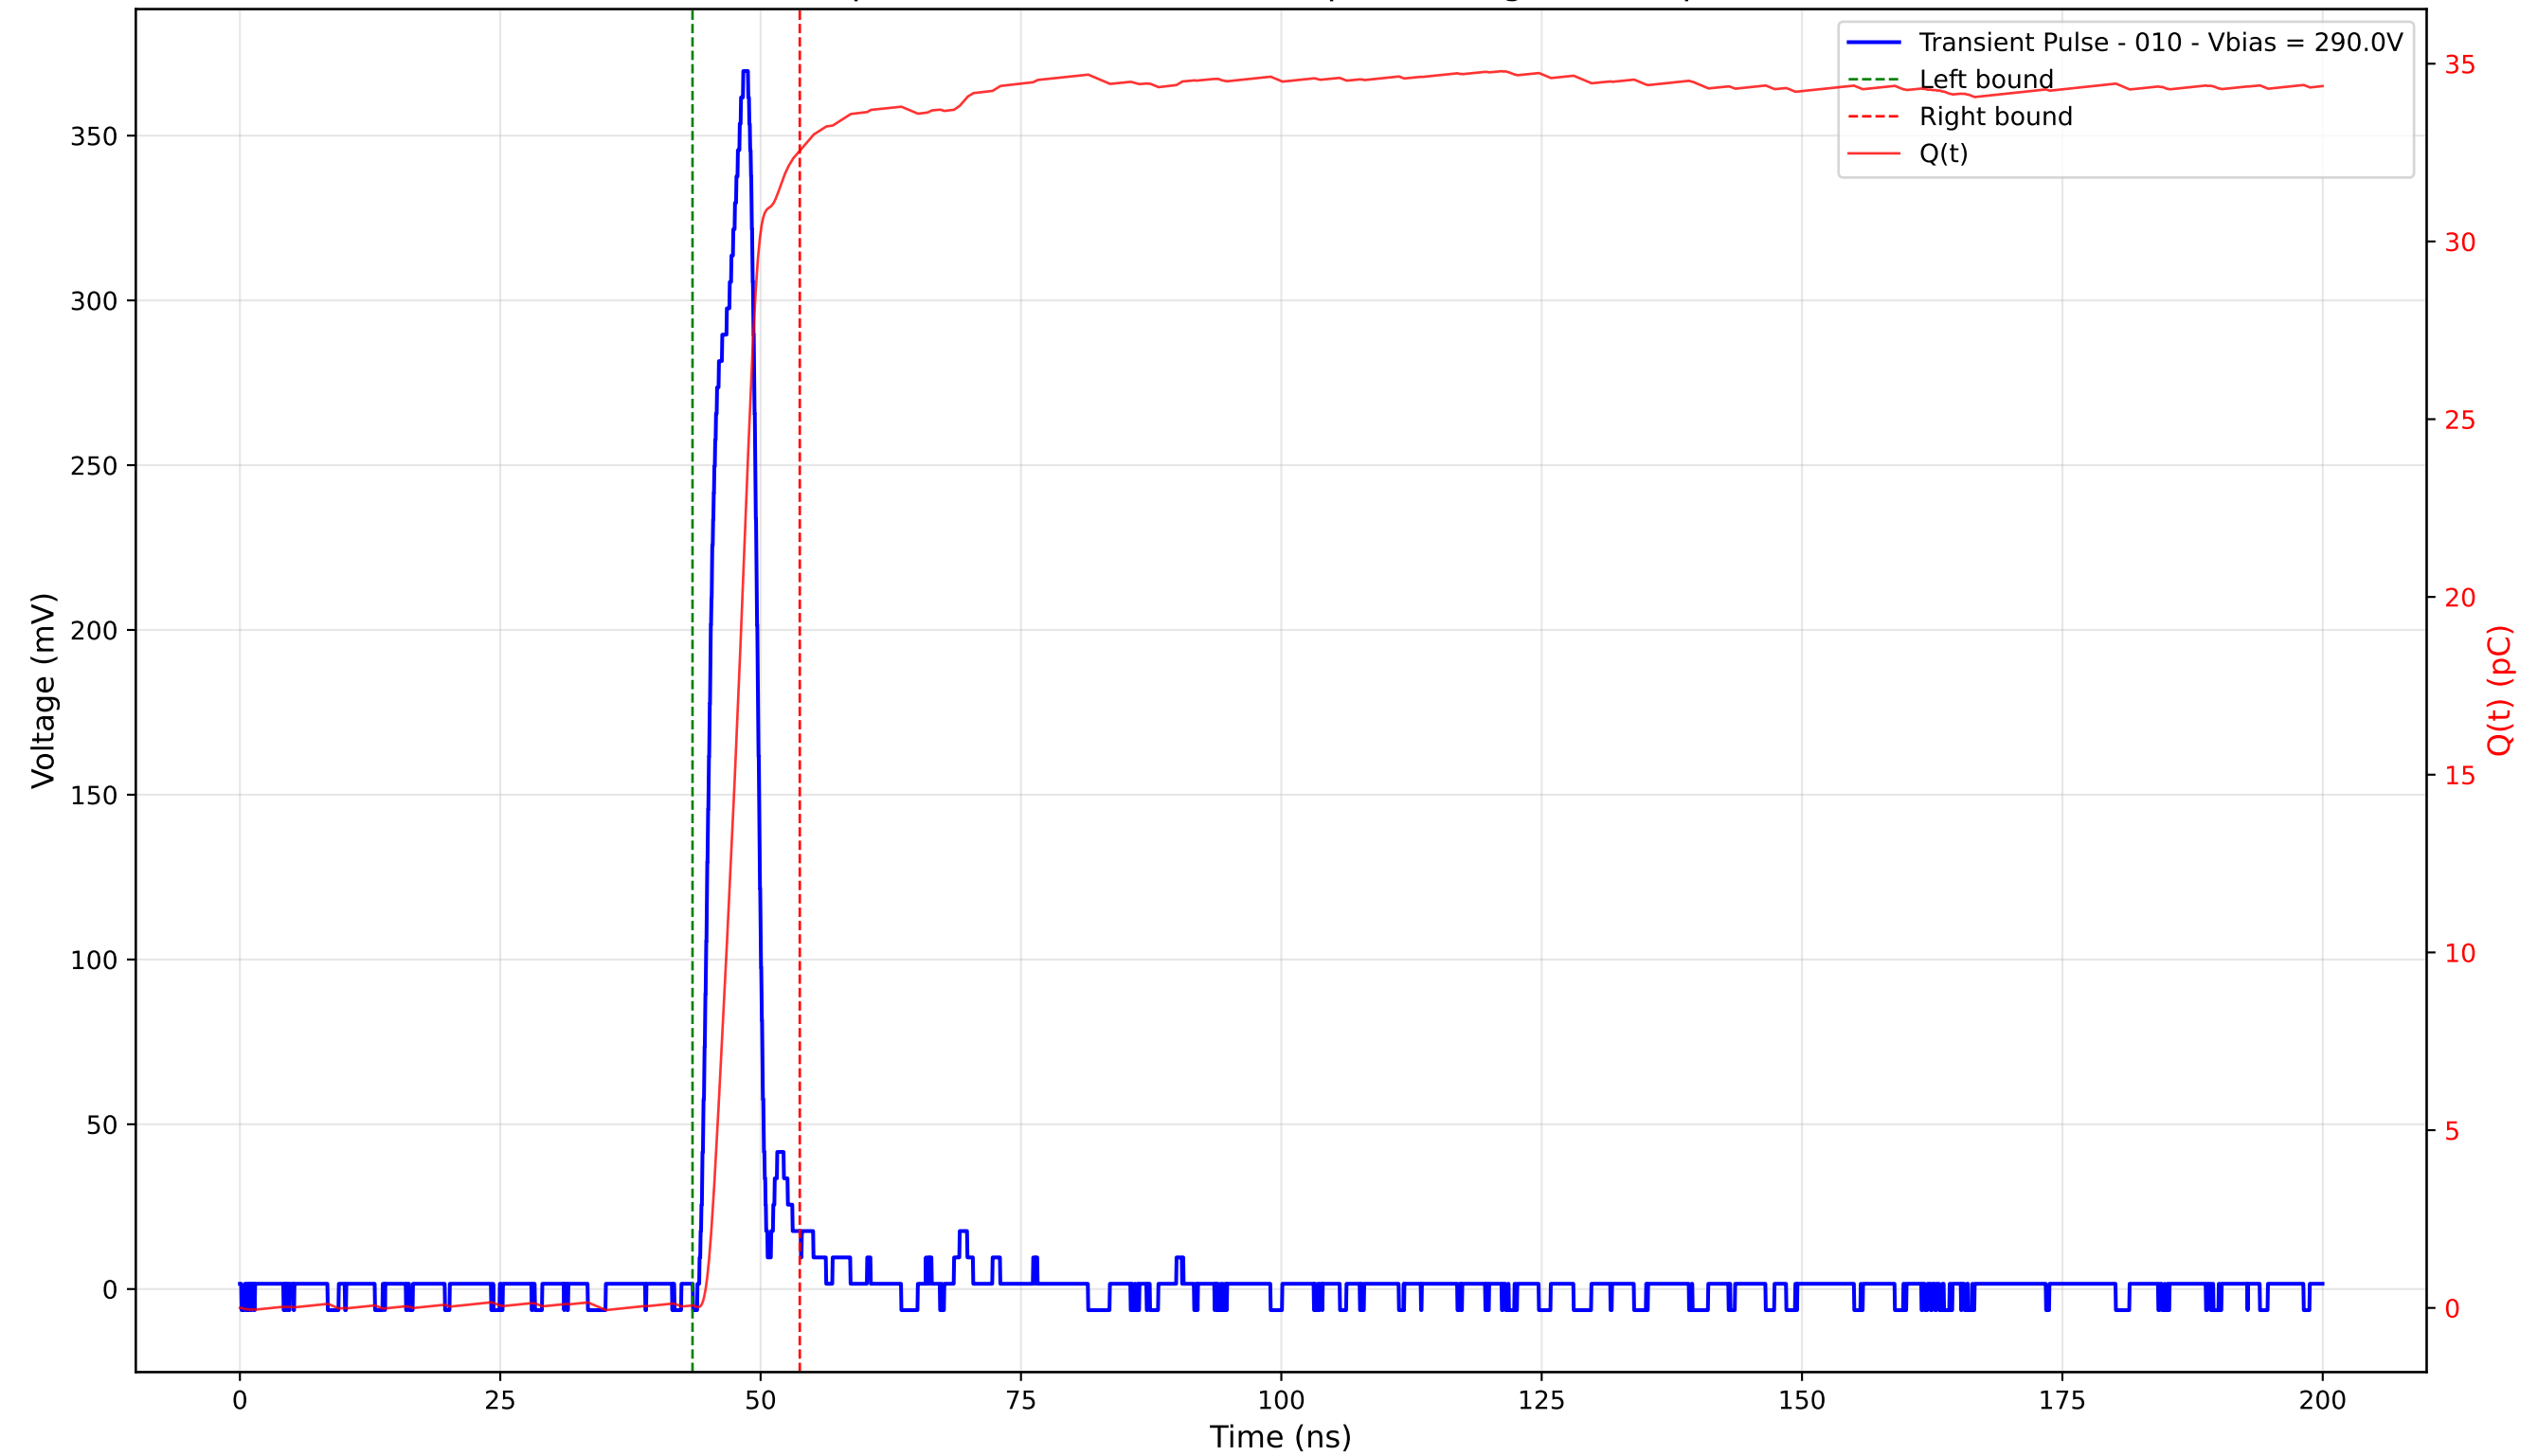


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 31.93 pC - Rise Time: 3.32 ns

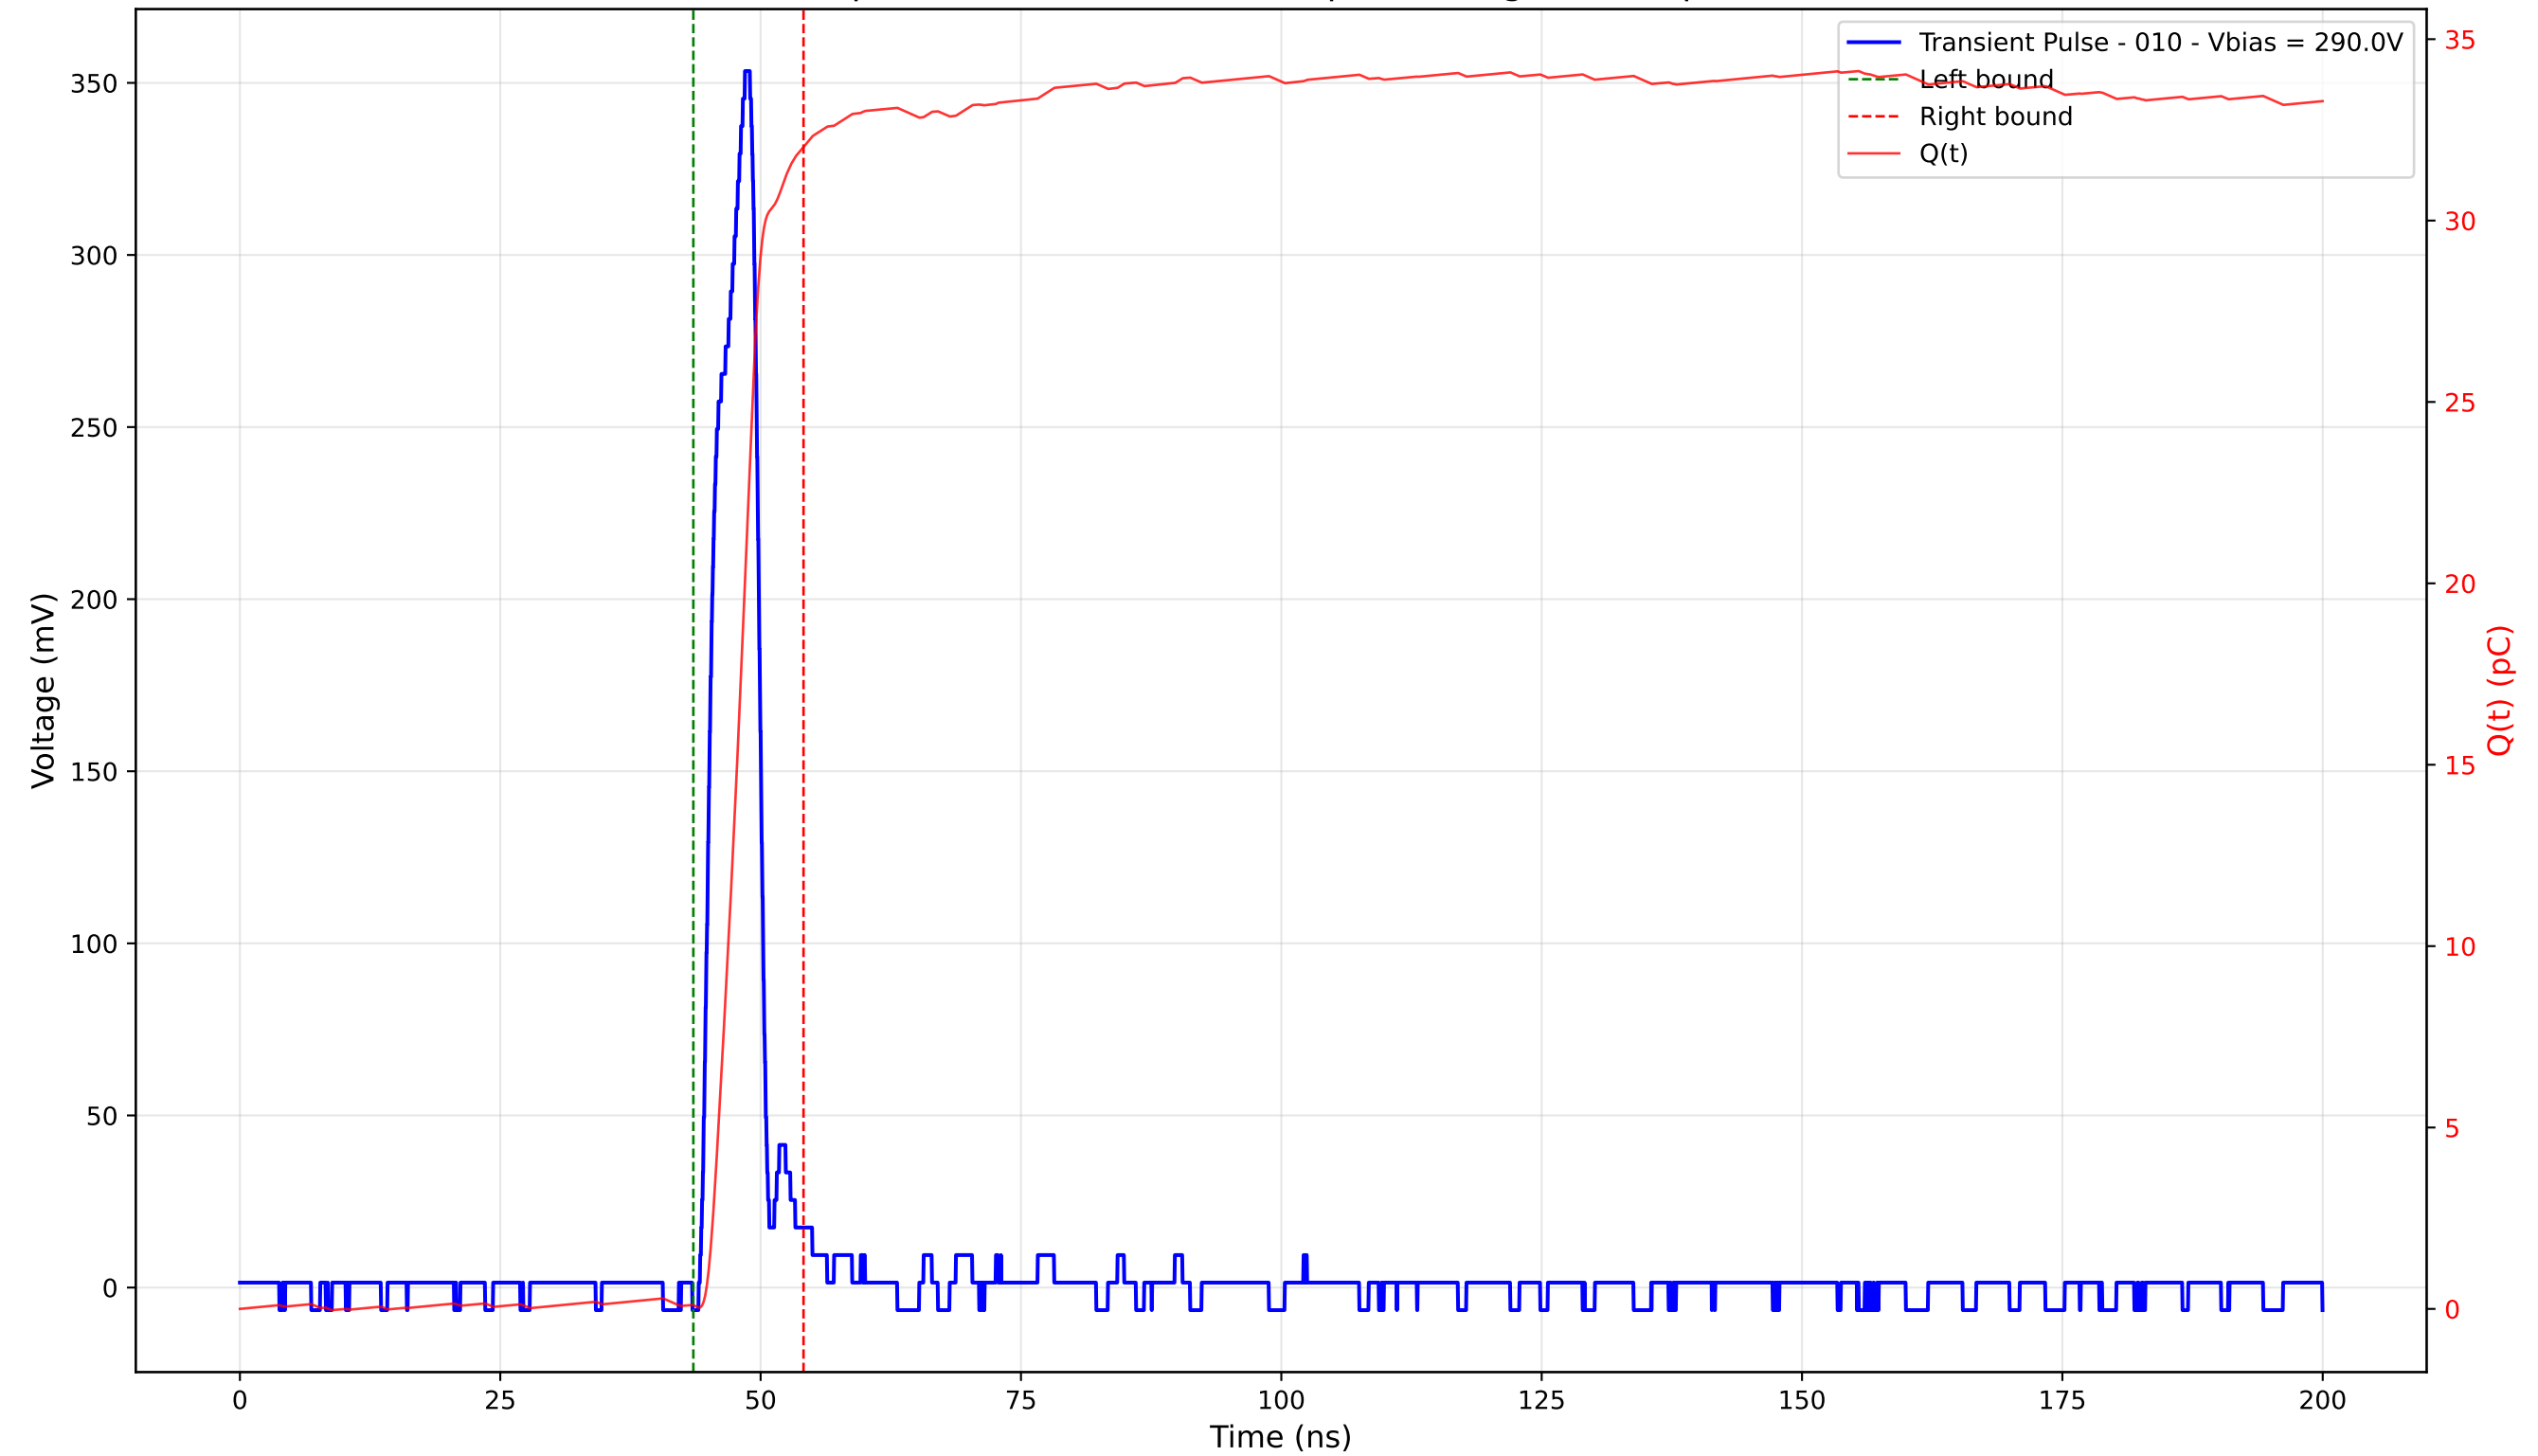


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 31.09 pC - Rise Time: 3.26 ns

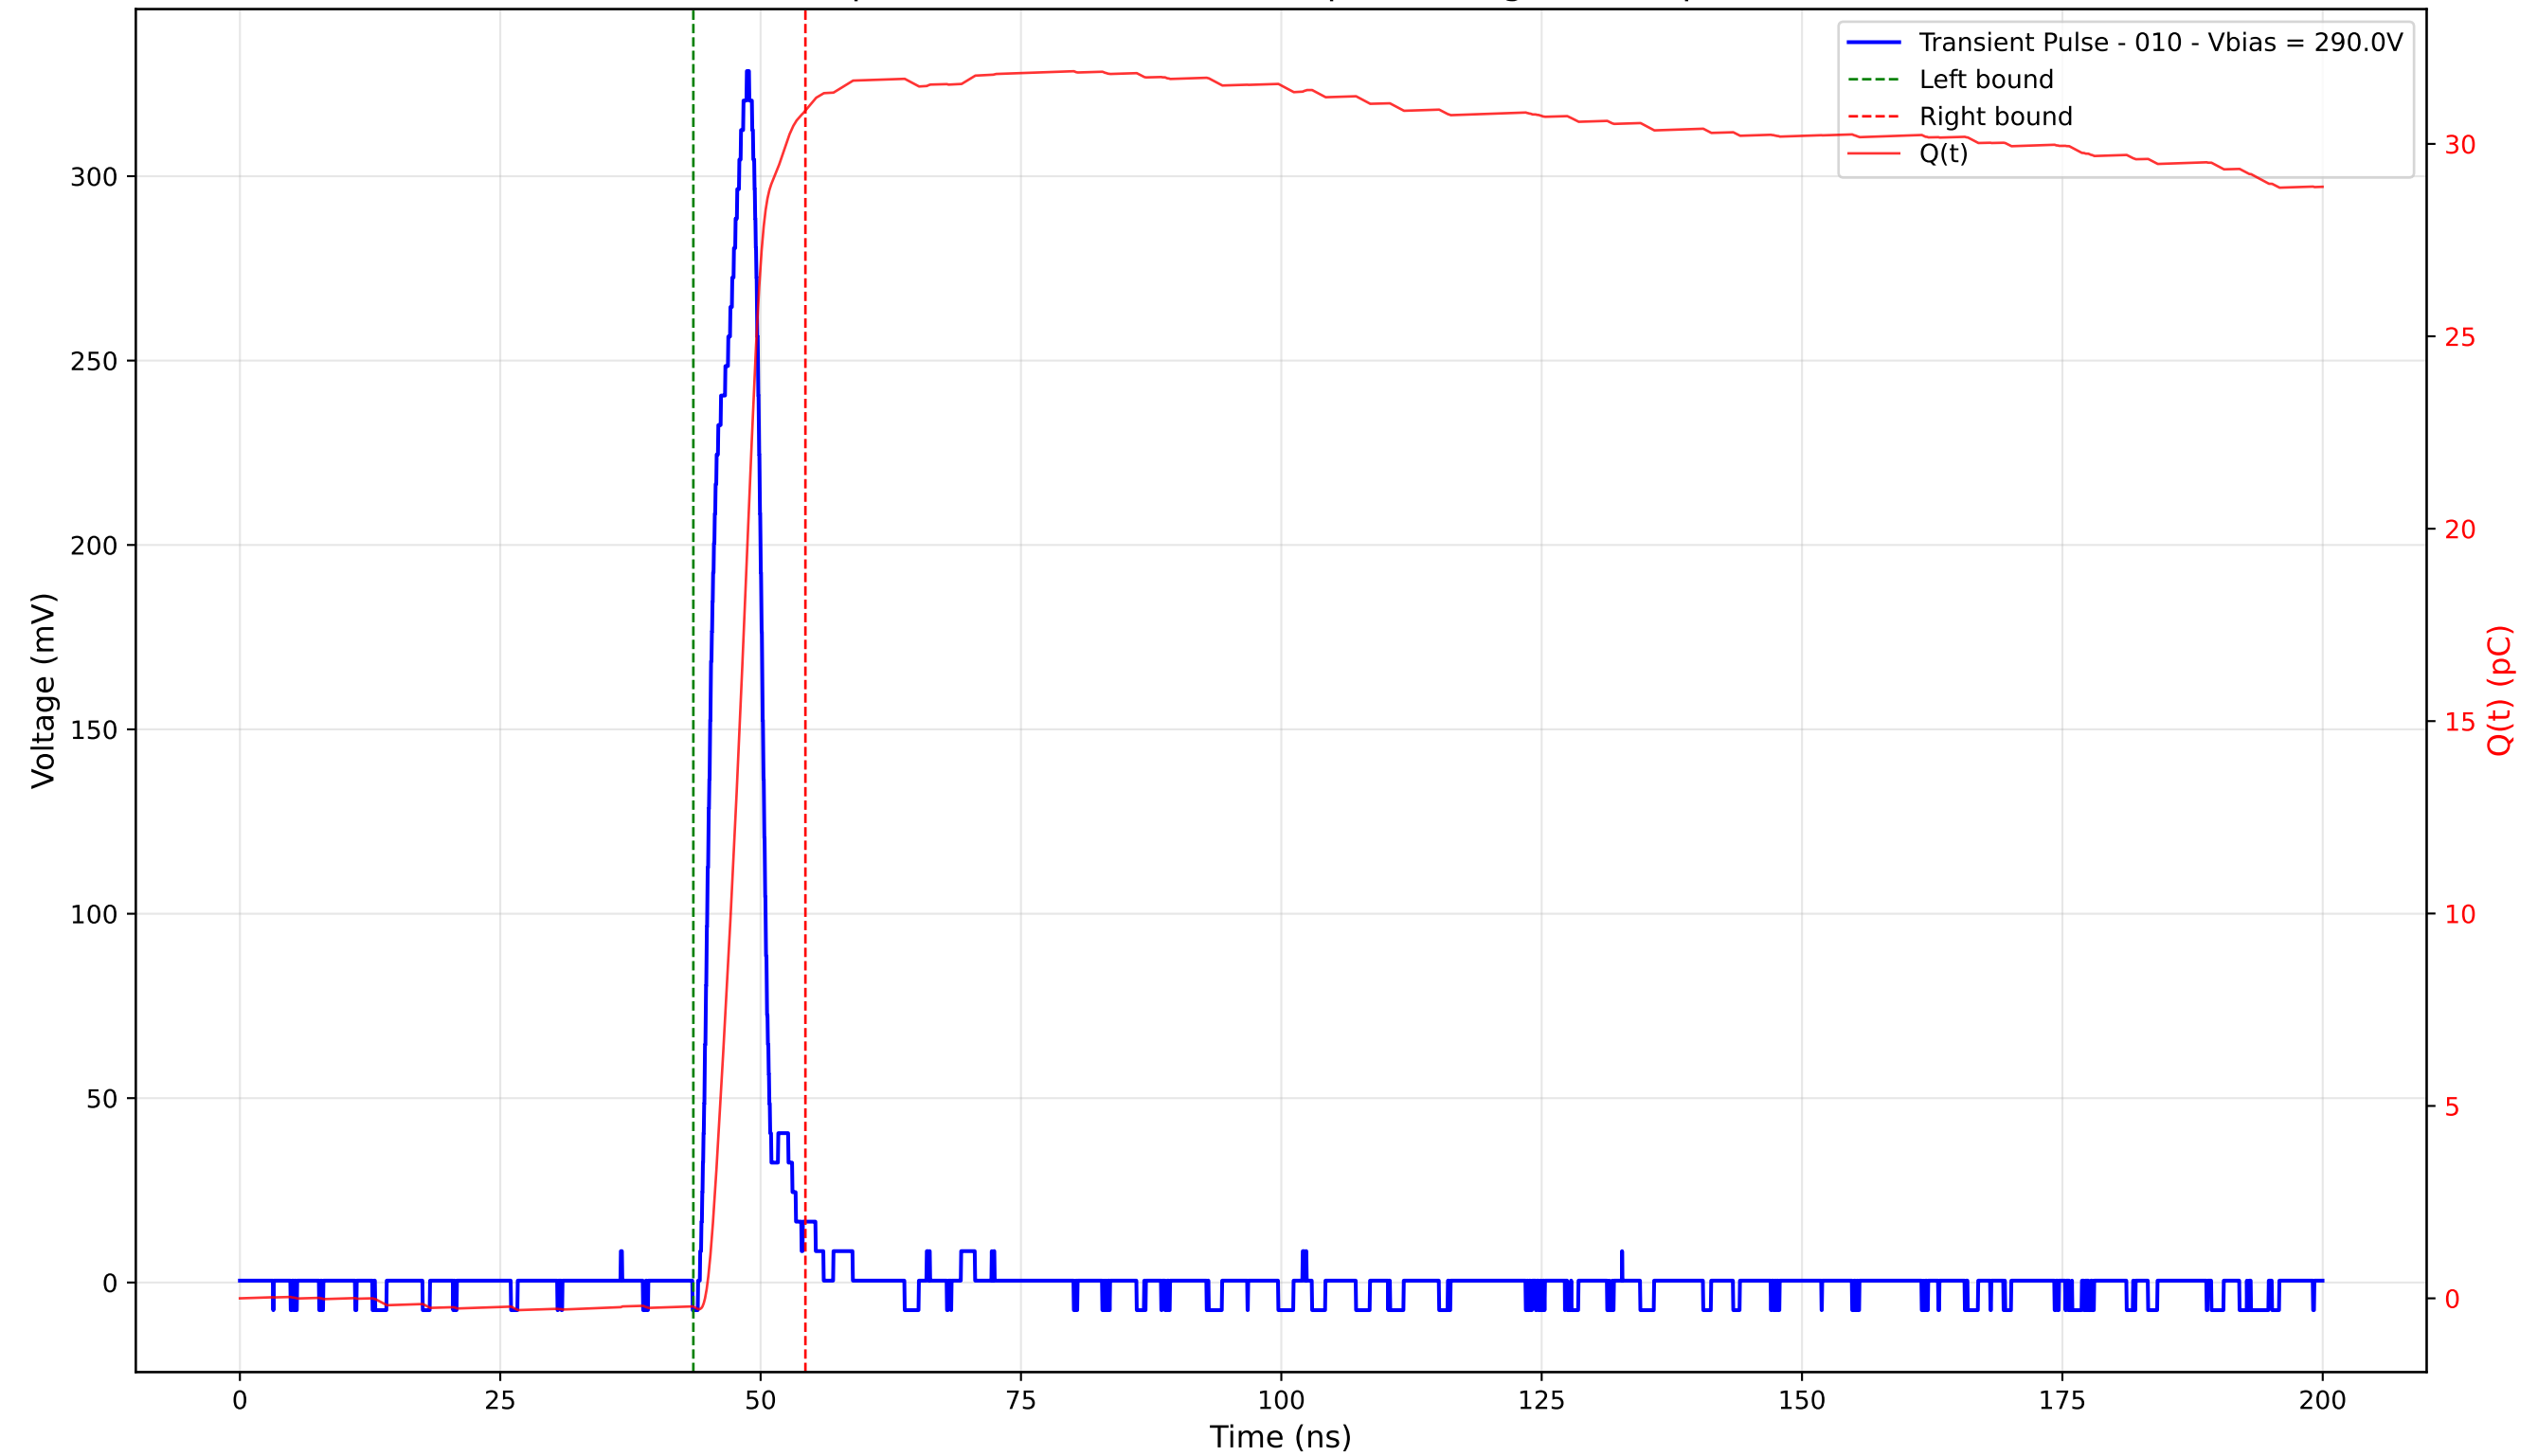


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 30.51 pC - Rise Time: 3.29 ns

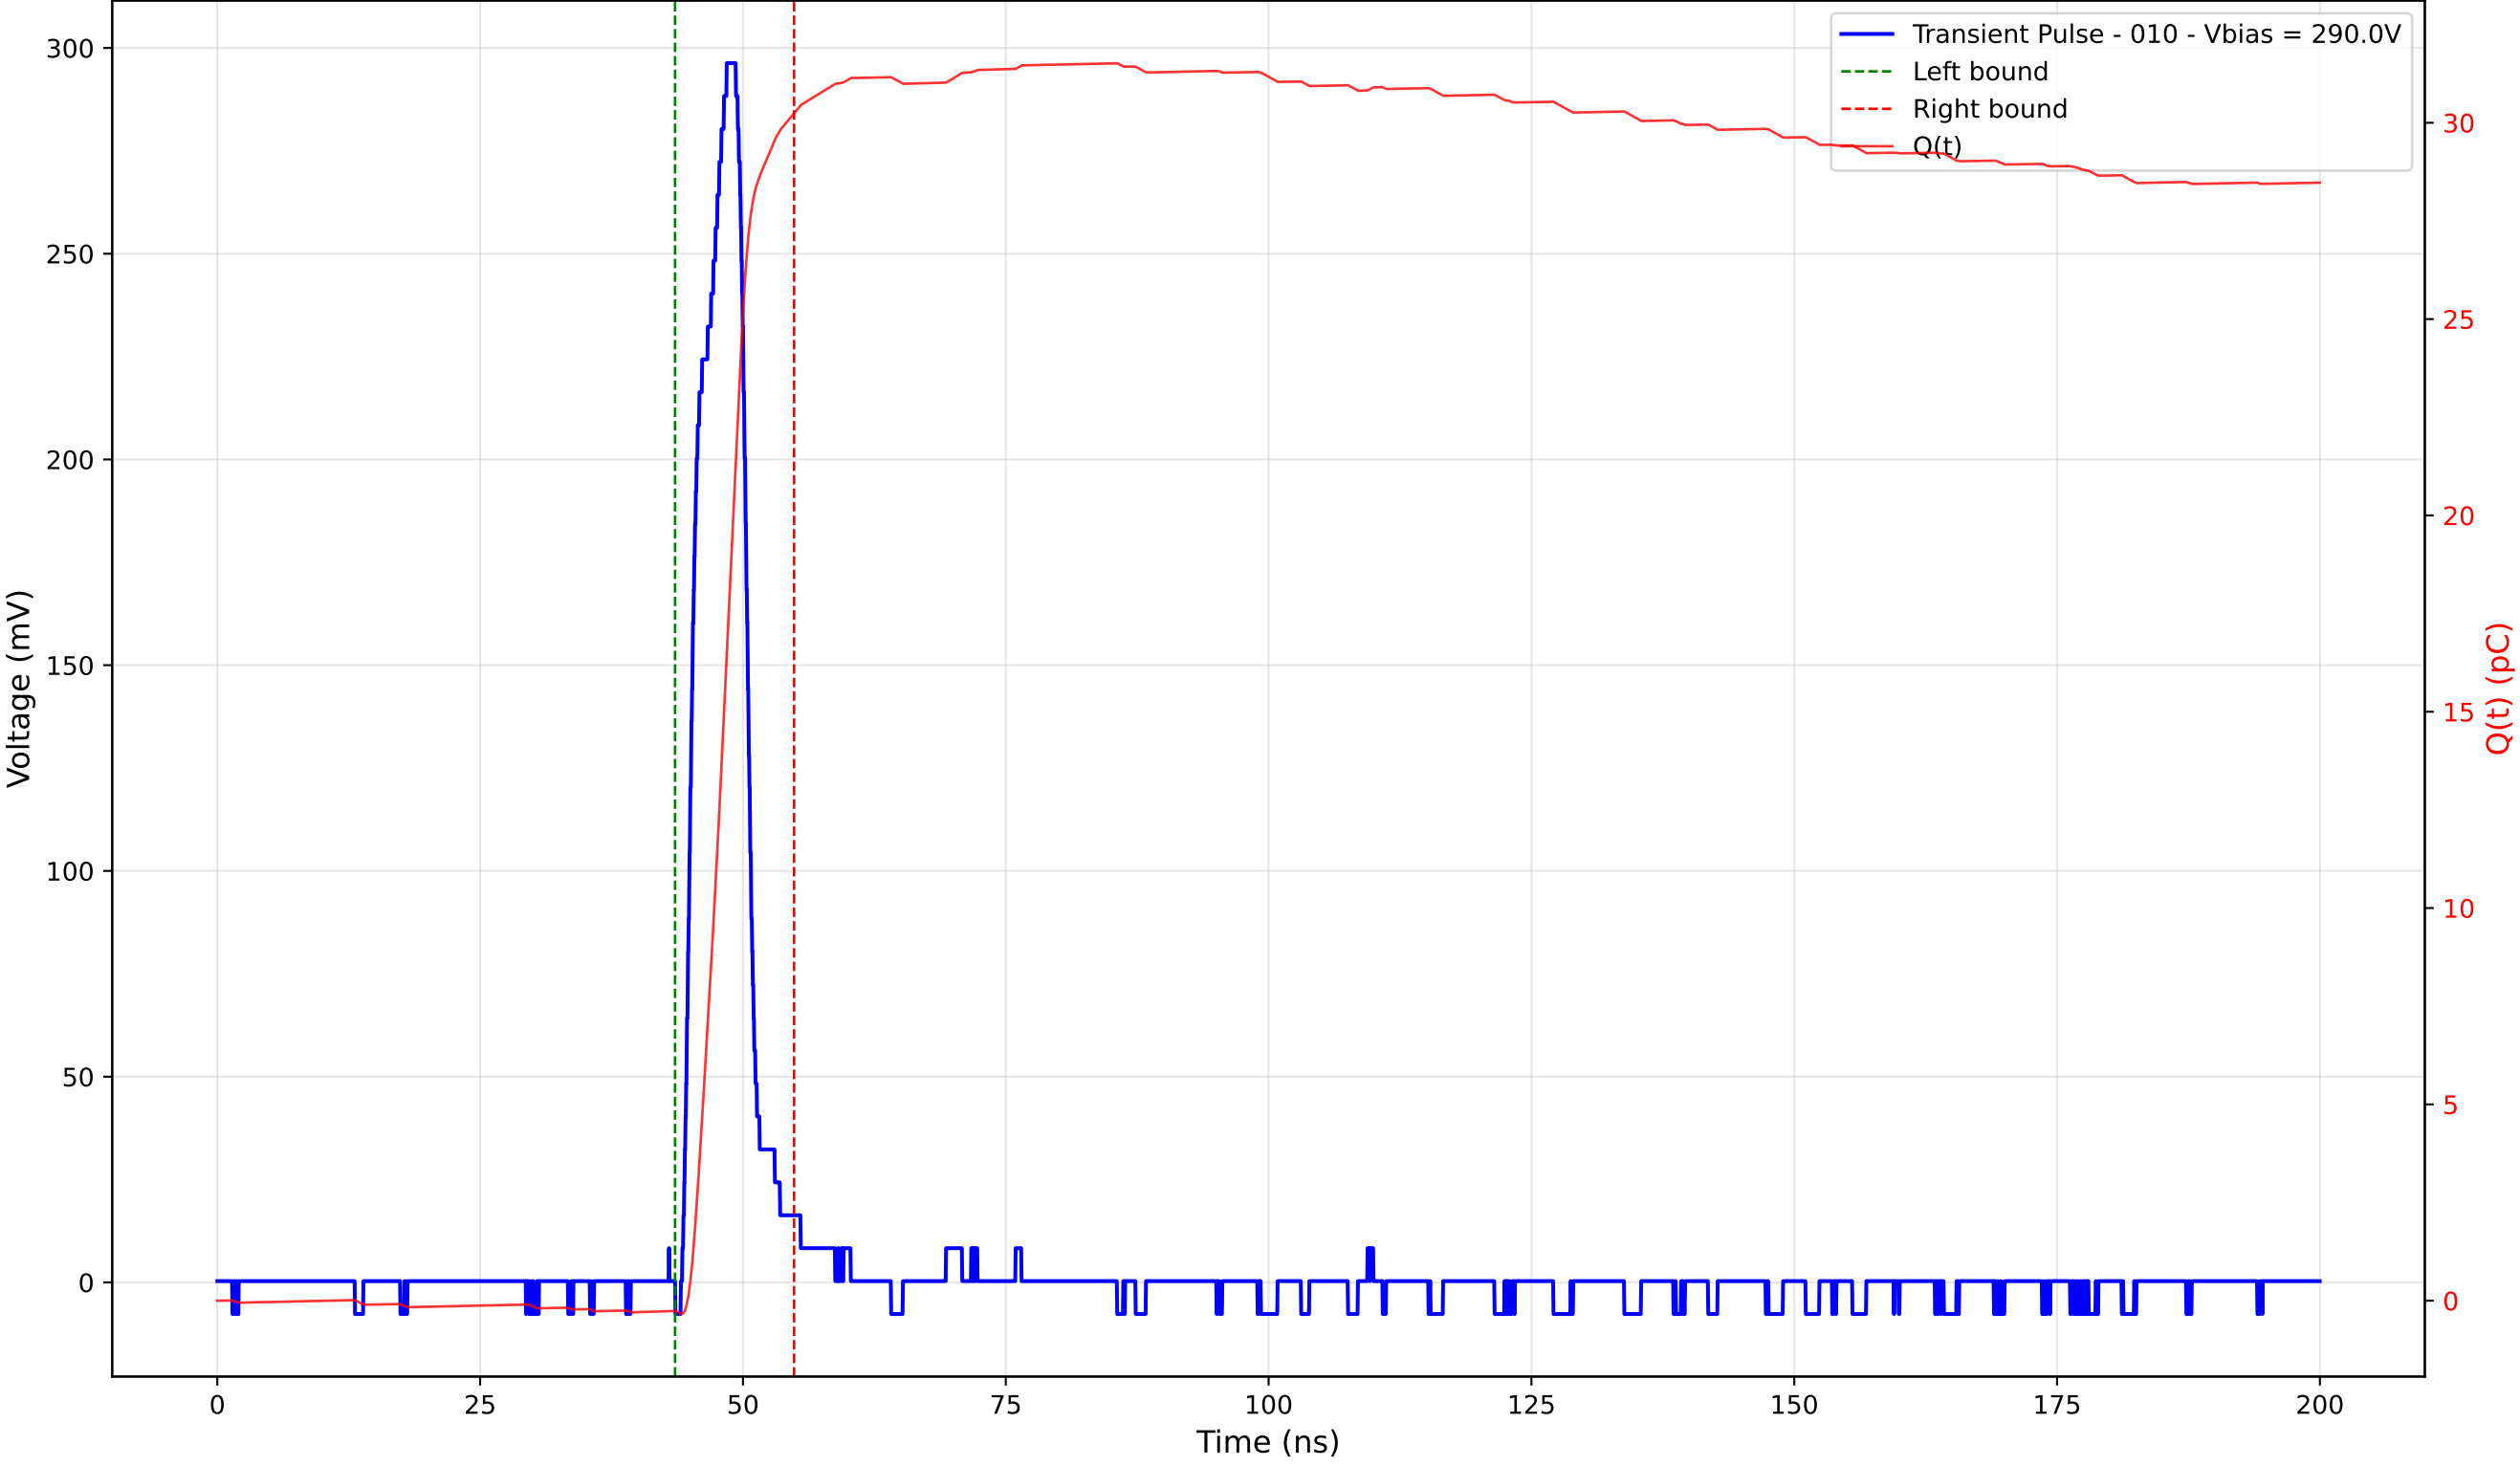


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 28.16 pC - Rise Time: 3.36 ns

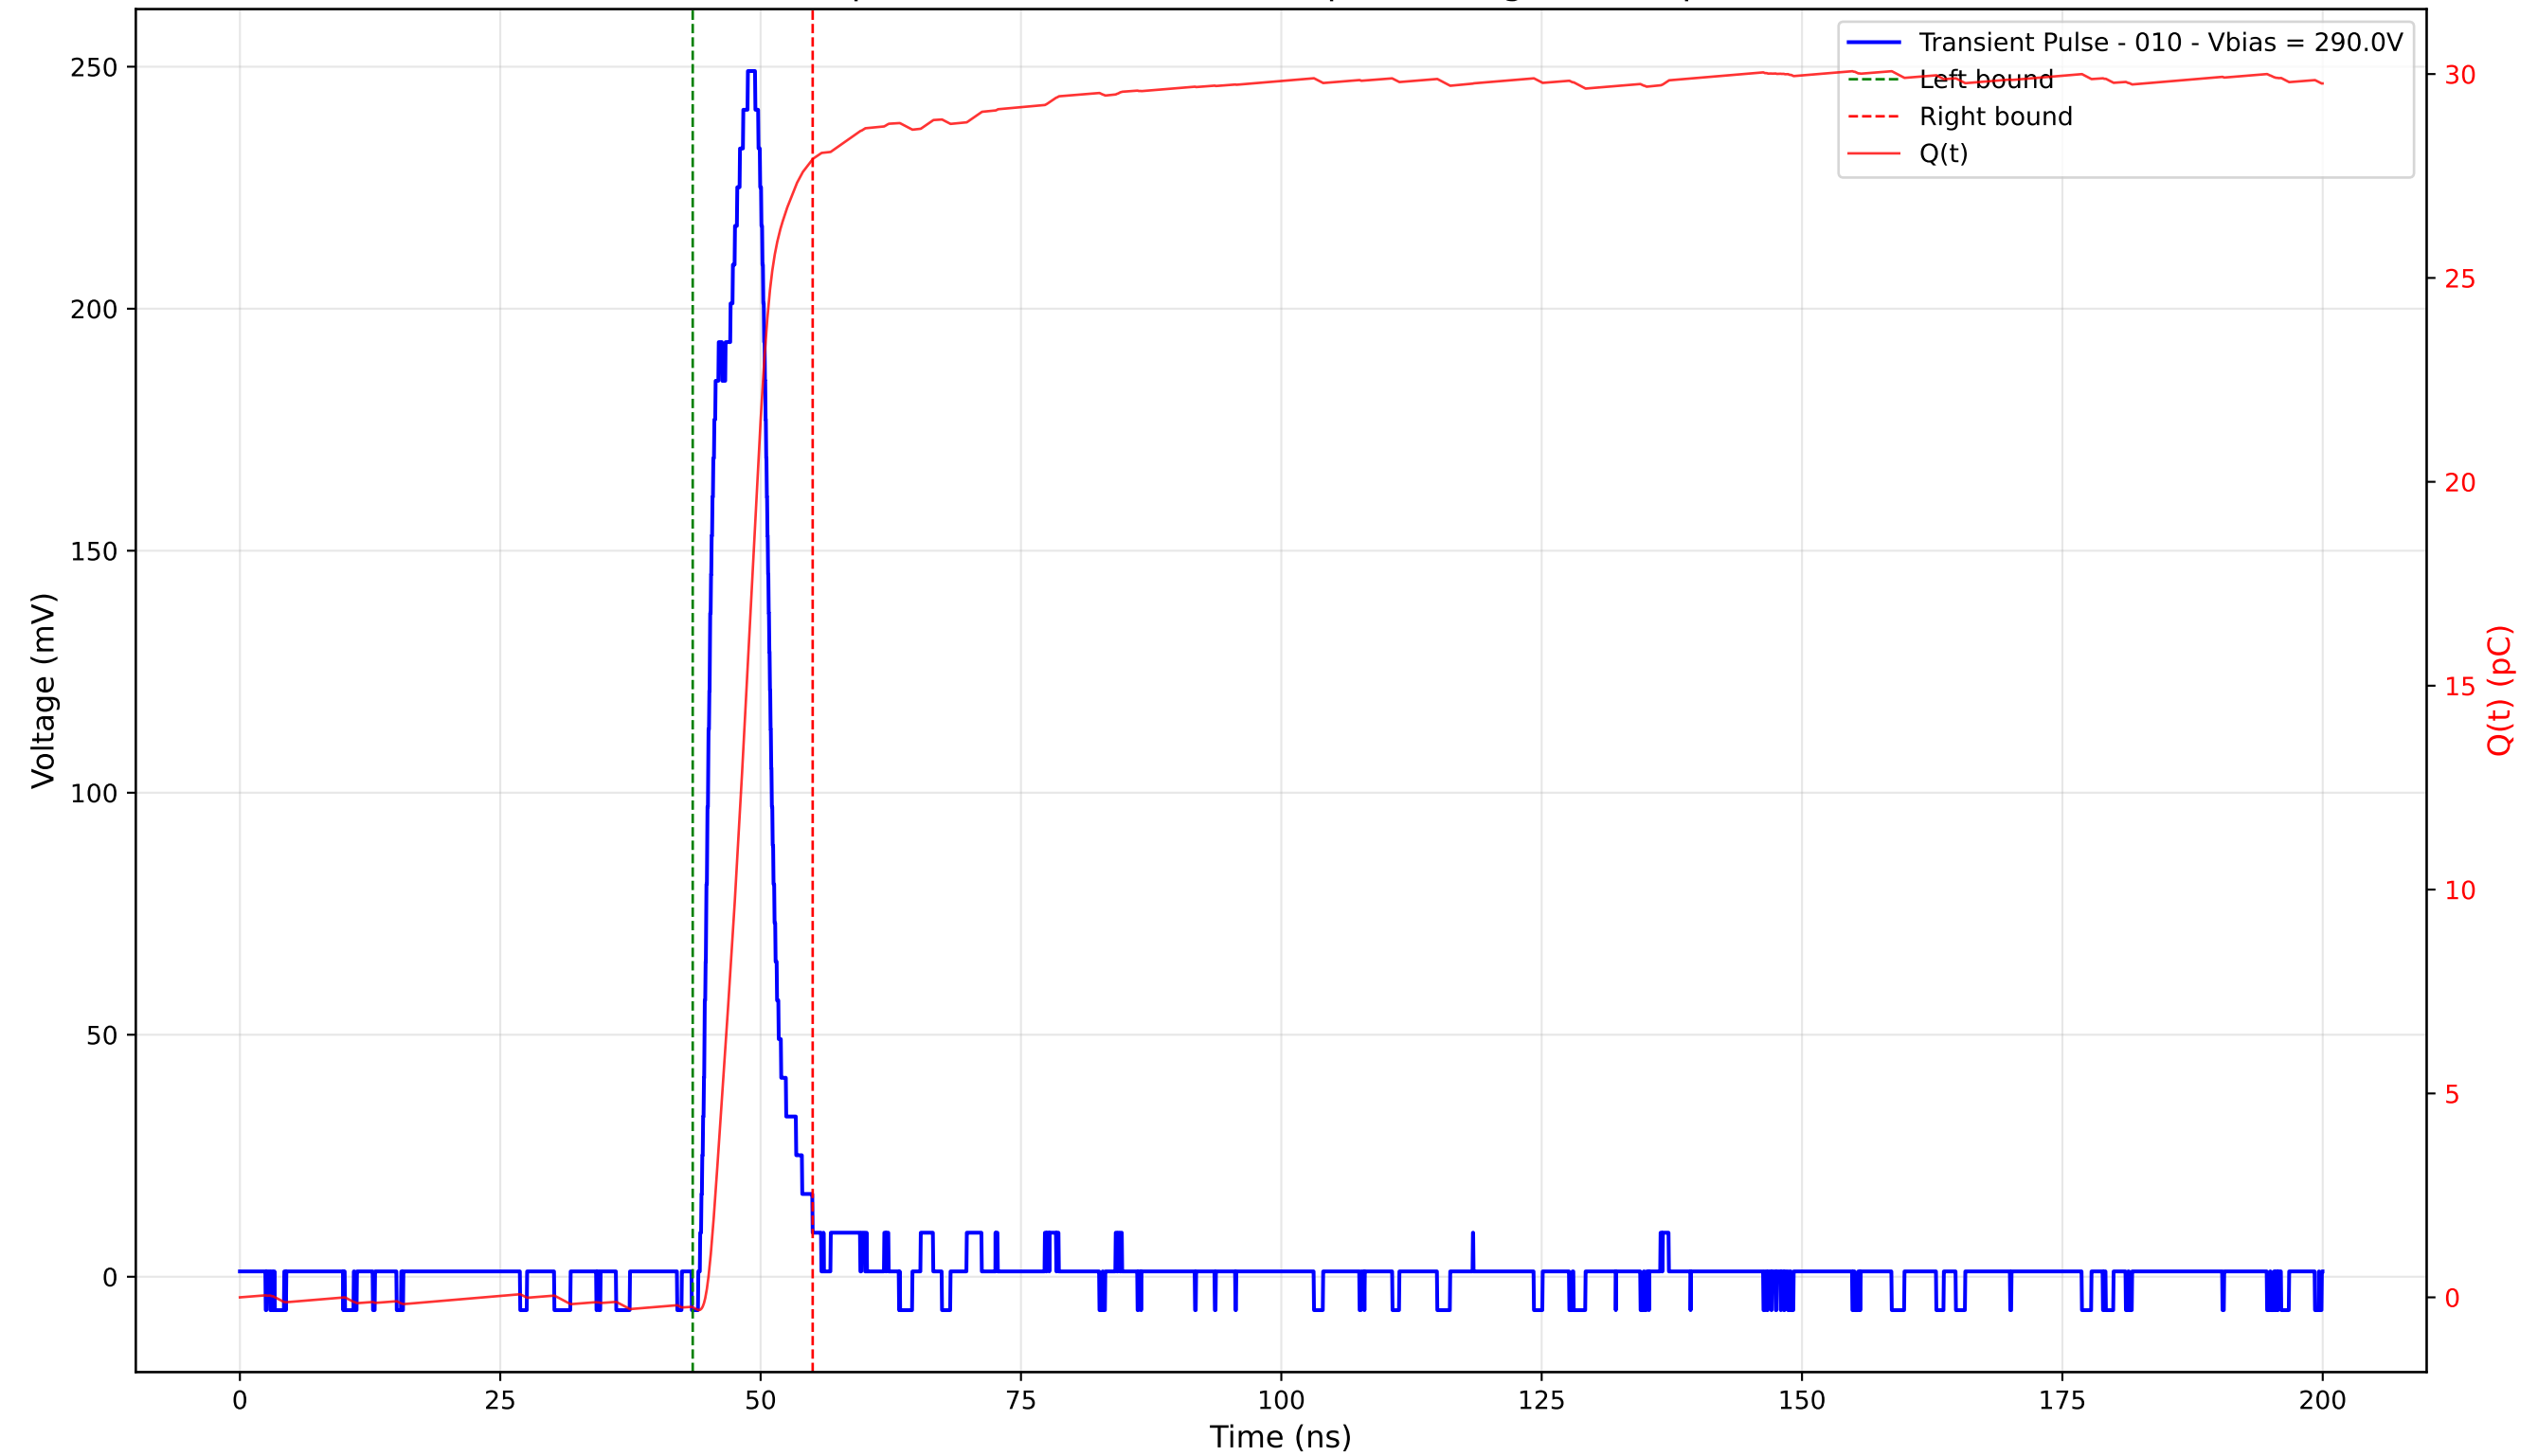


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 23.16 pC - Rise Time: 3.22 ns

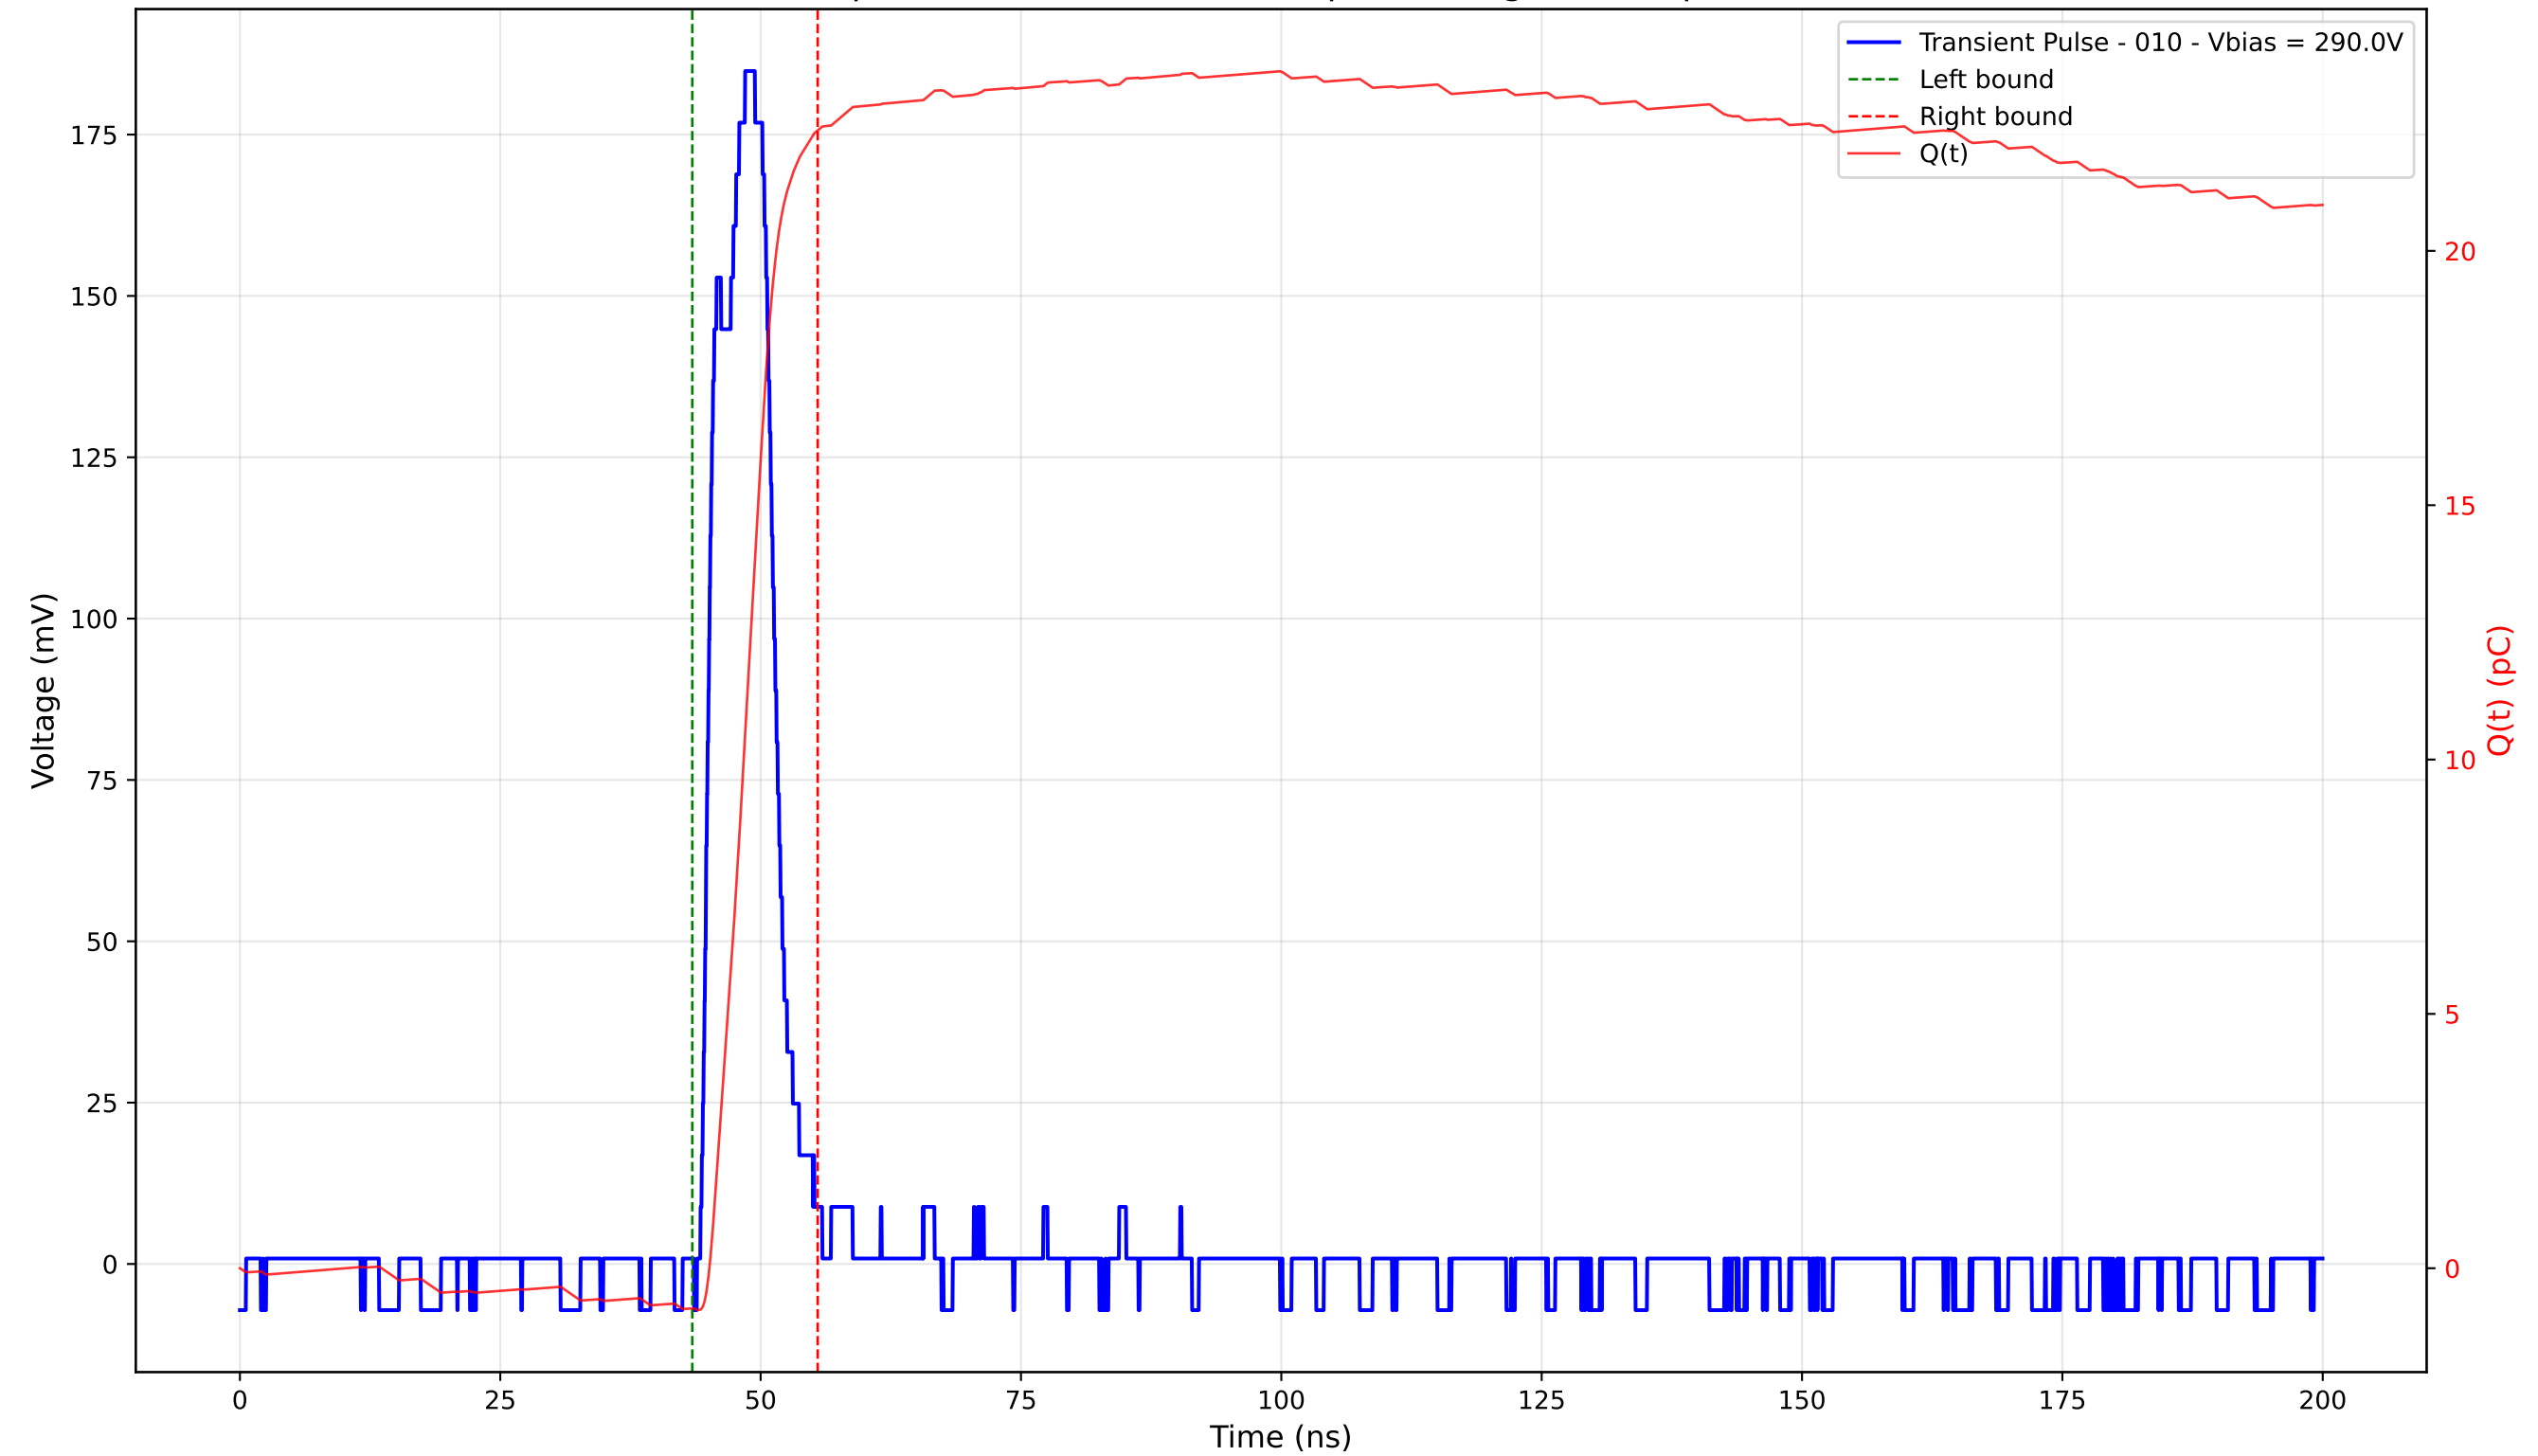


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 18.61 pC - Rise Time: 1.29 ns

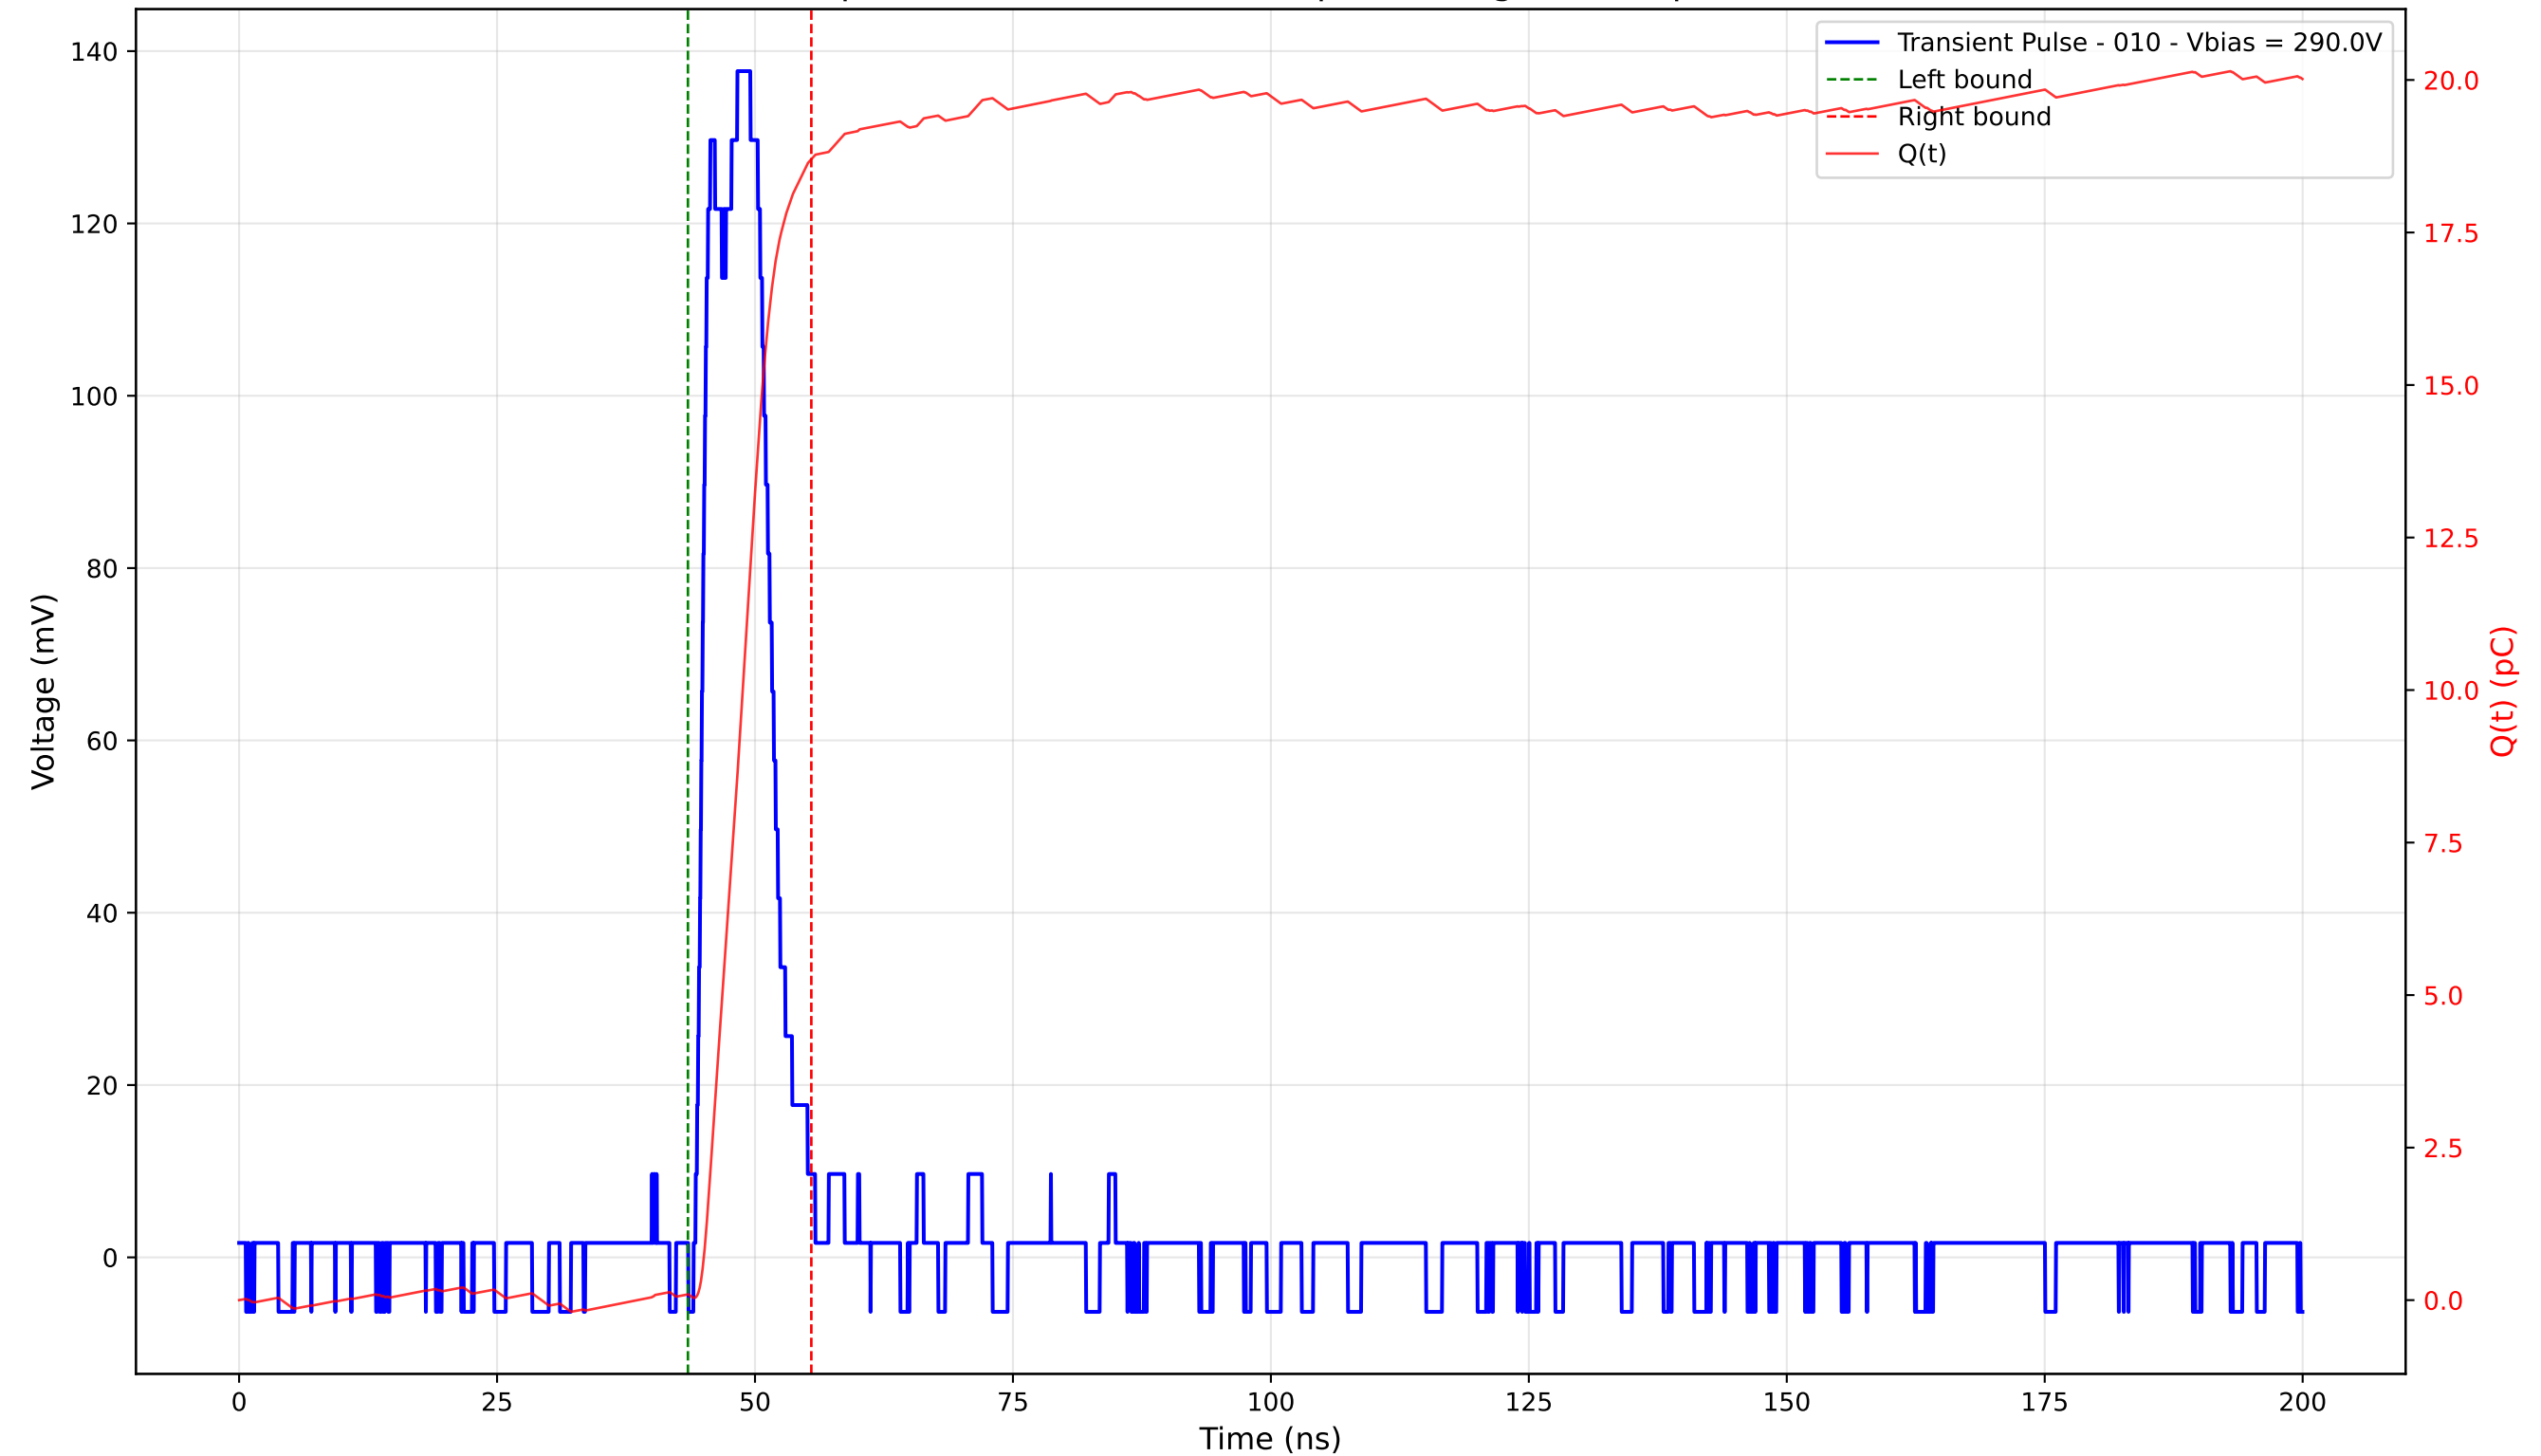


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 13.49 pC - Rise Time: 1.00 ns

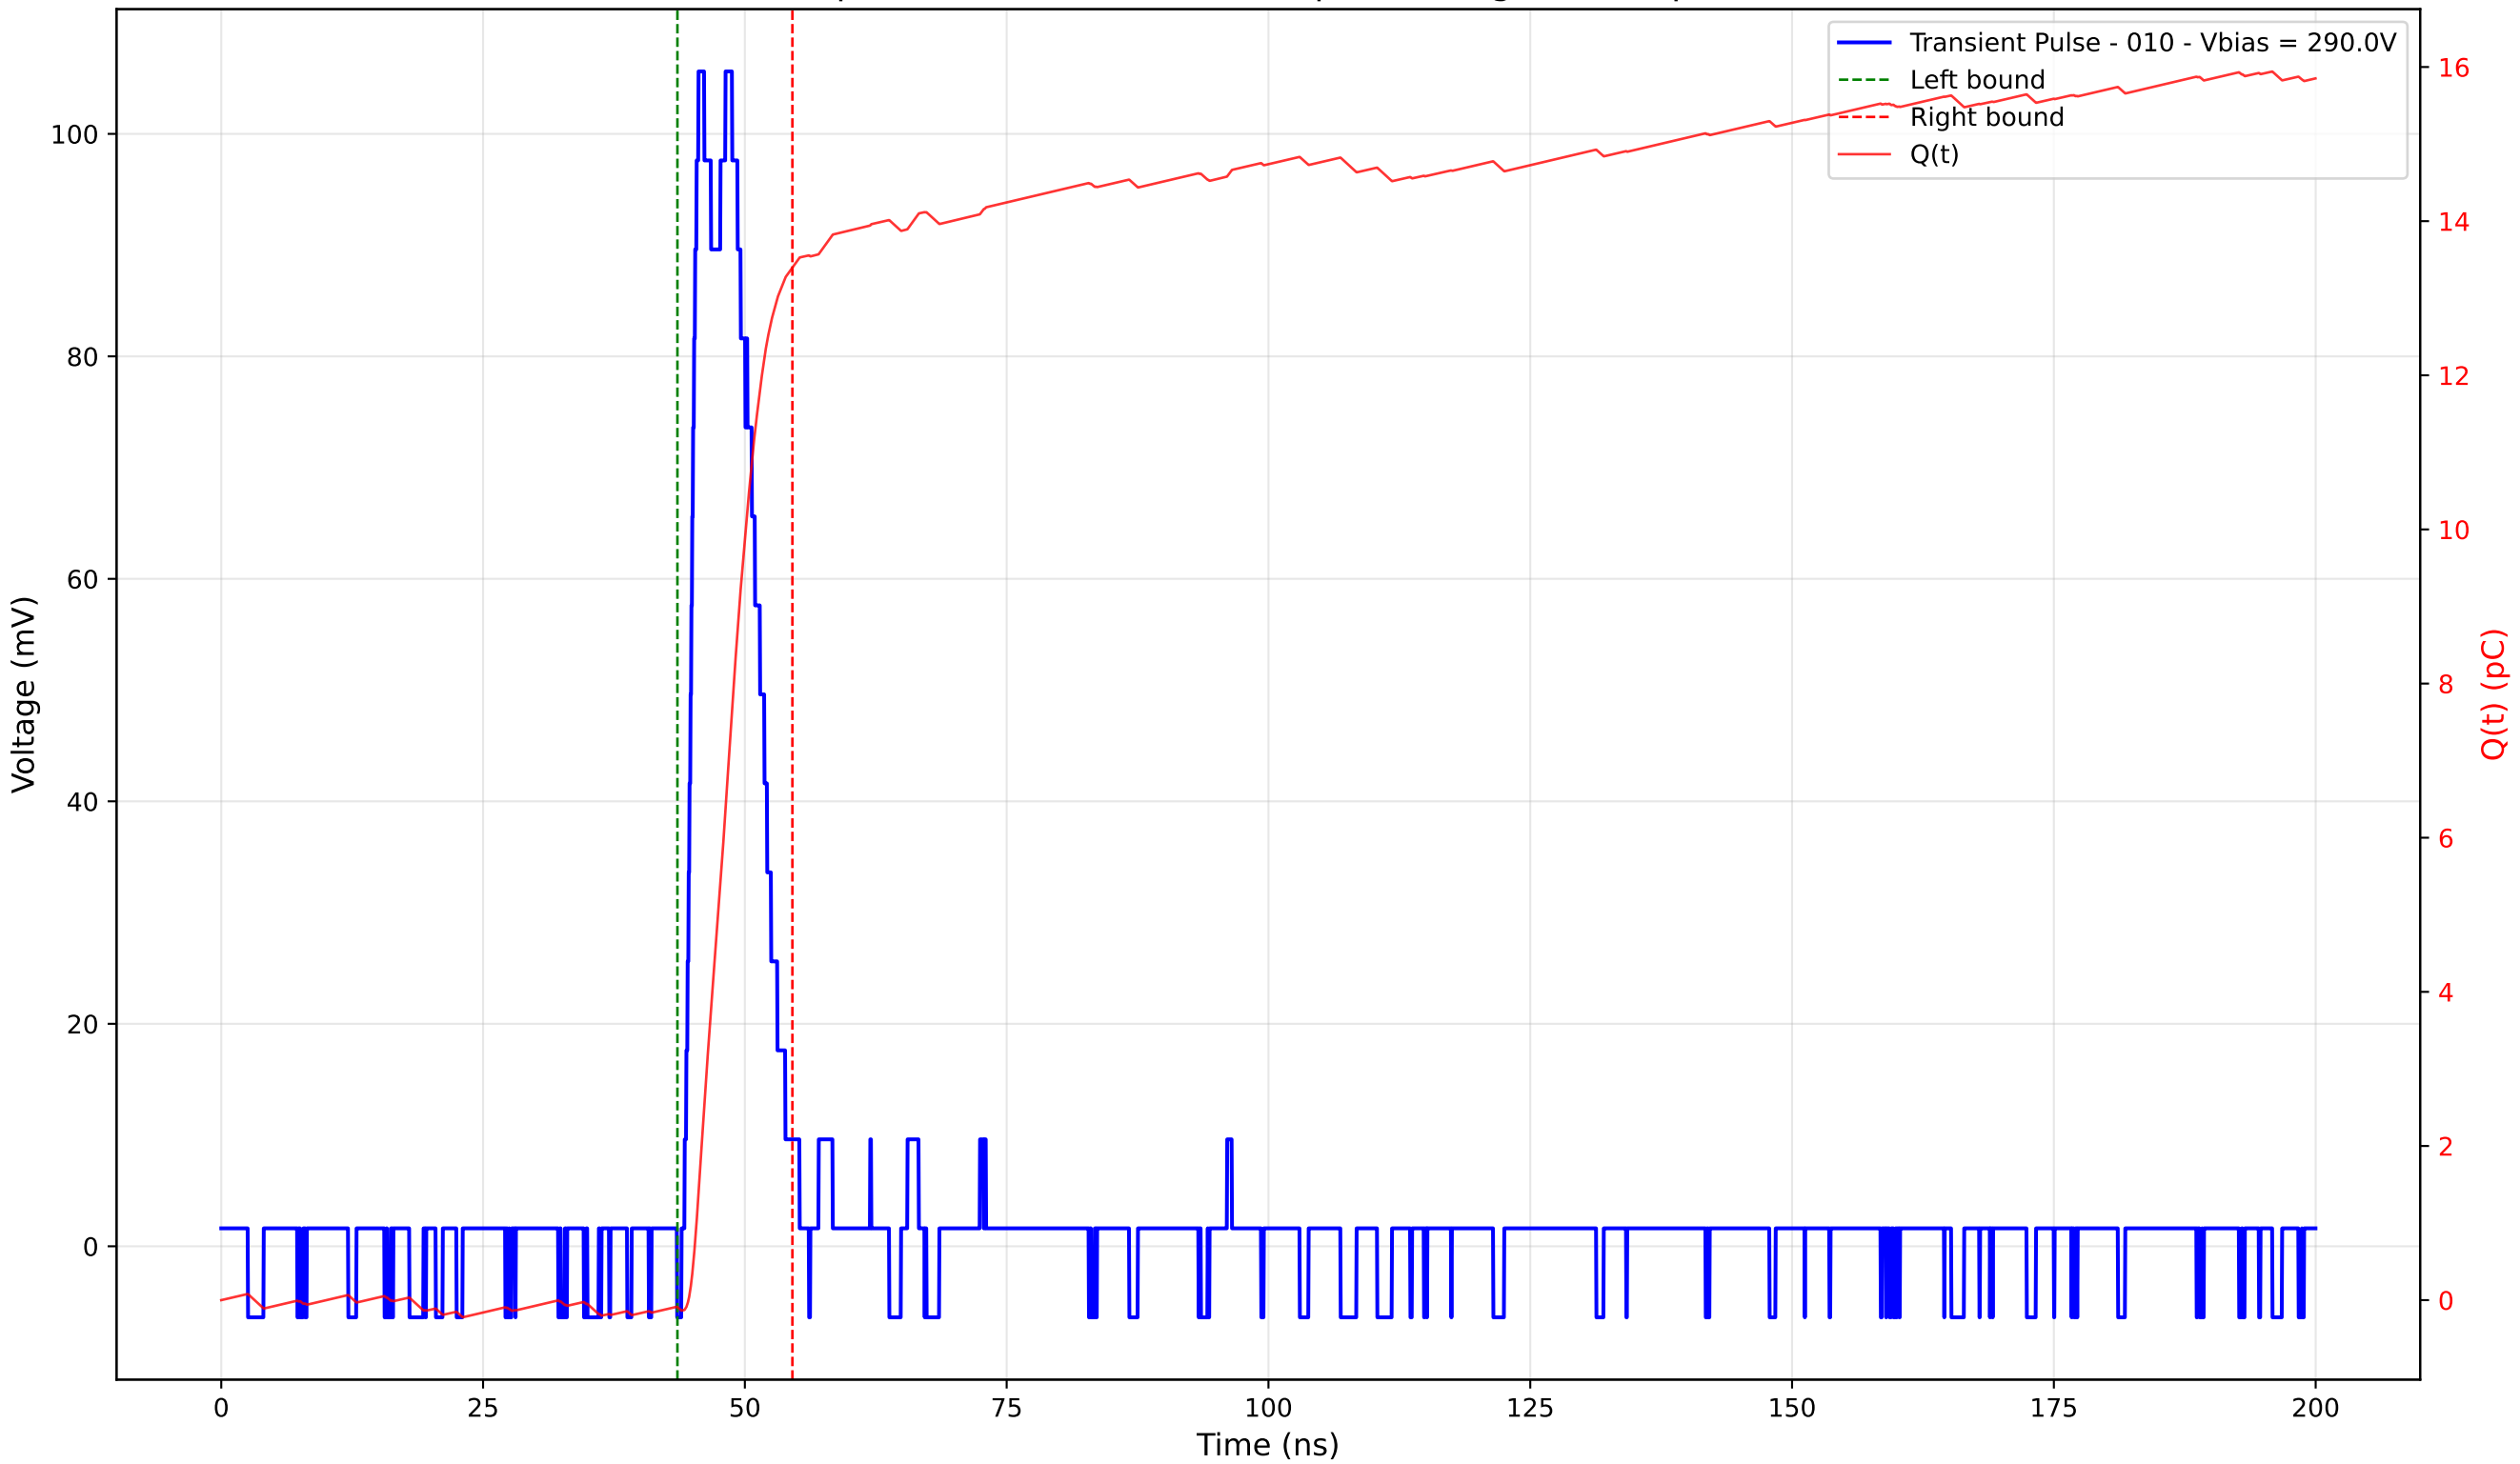


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 8.82 pC - Rise Time: 0.94 ns

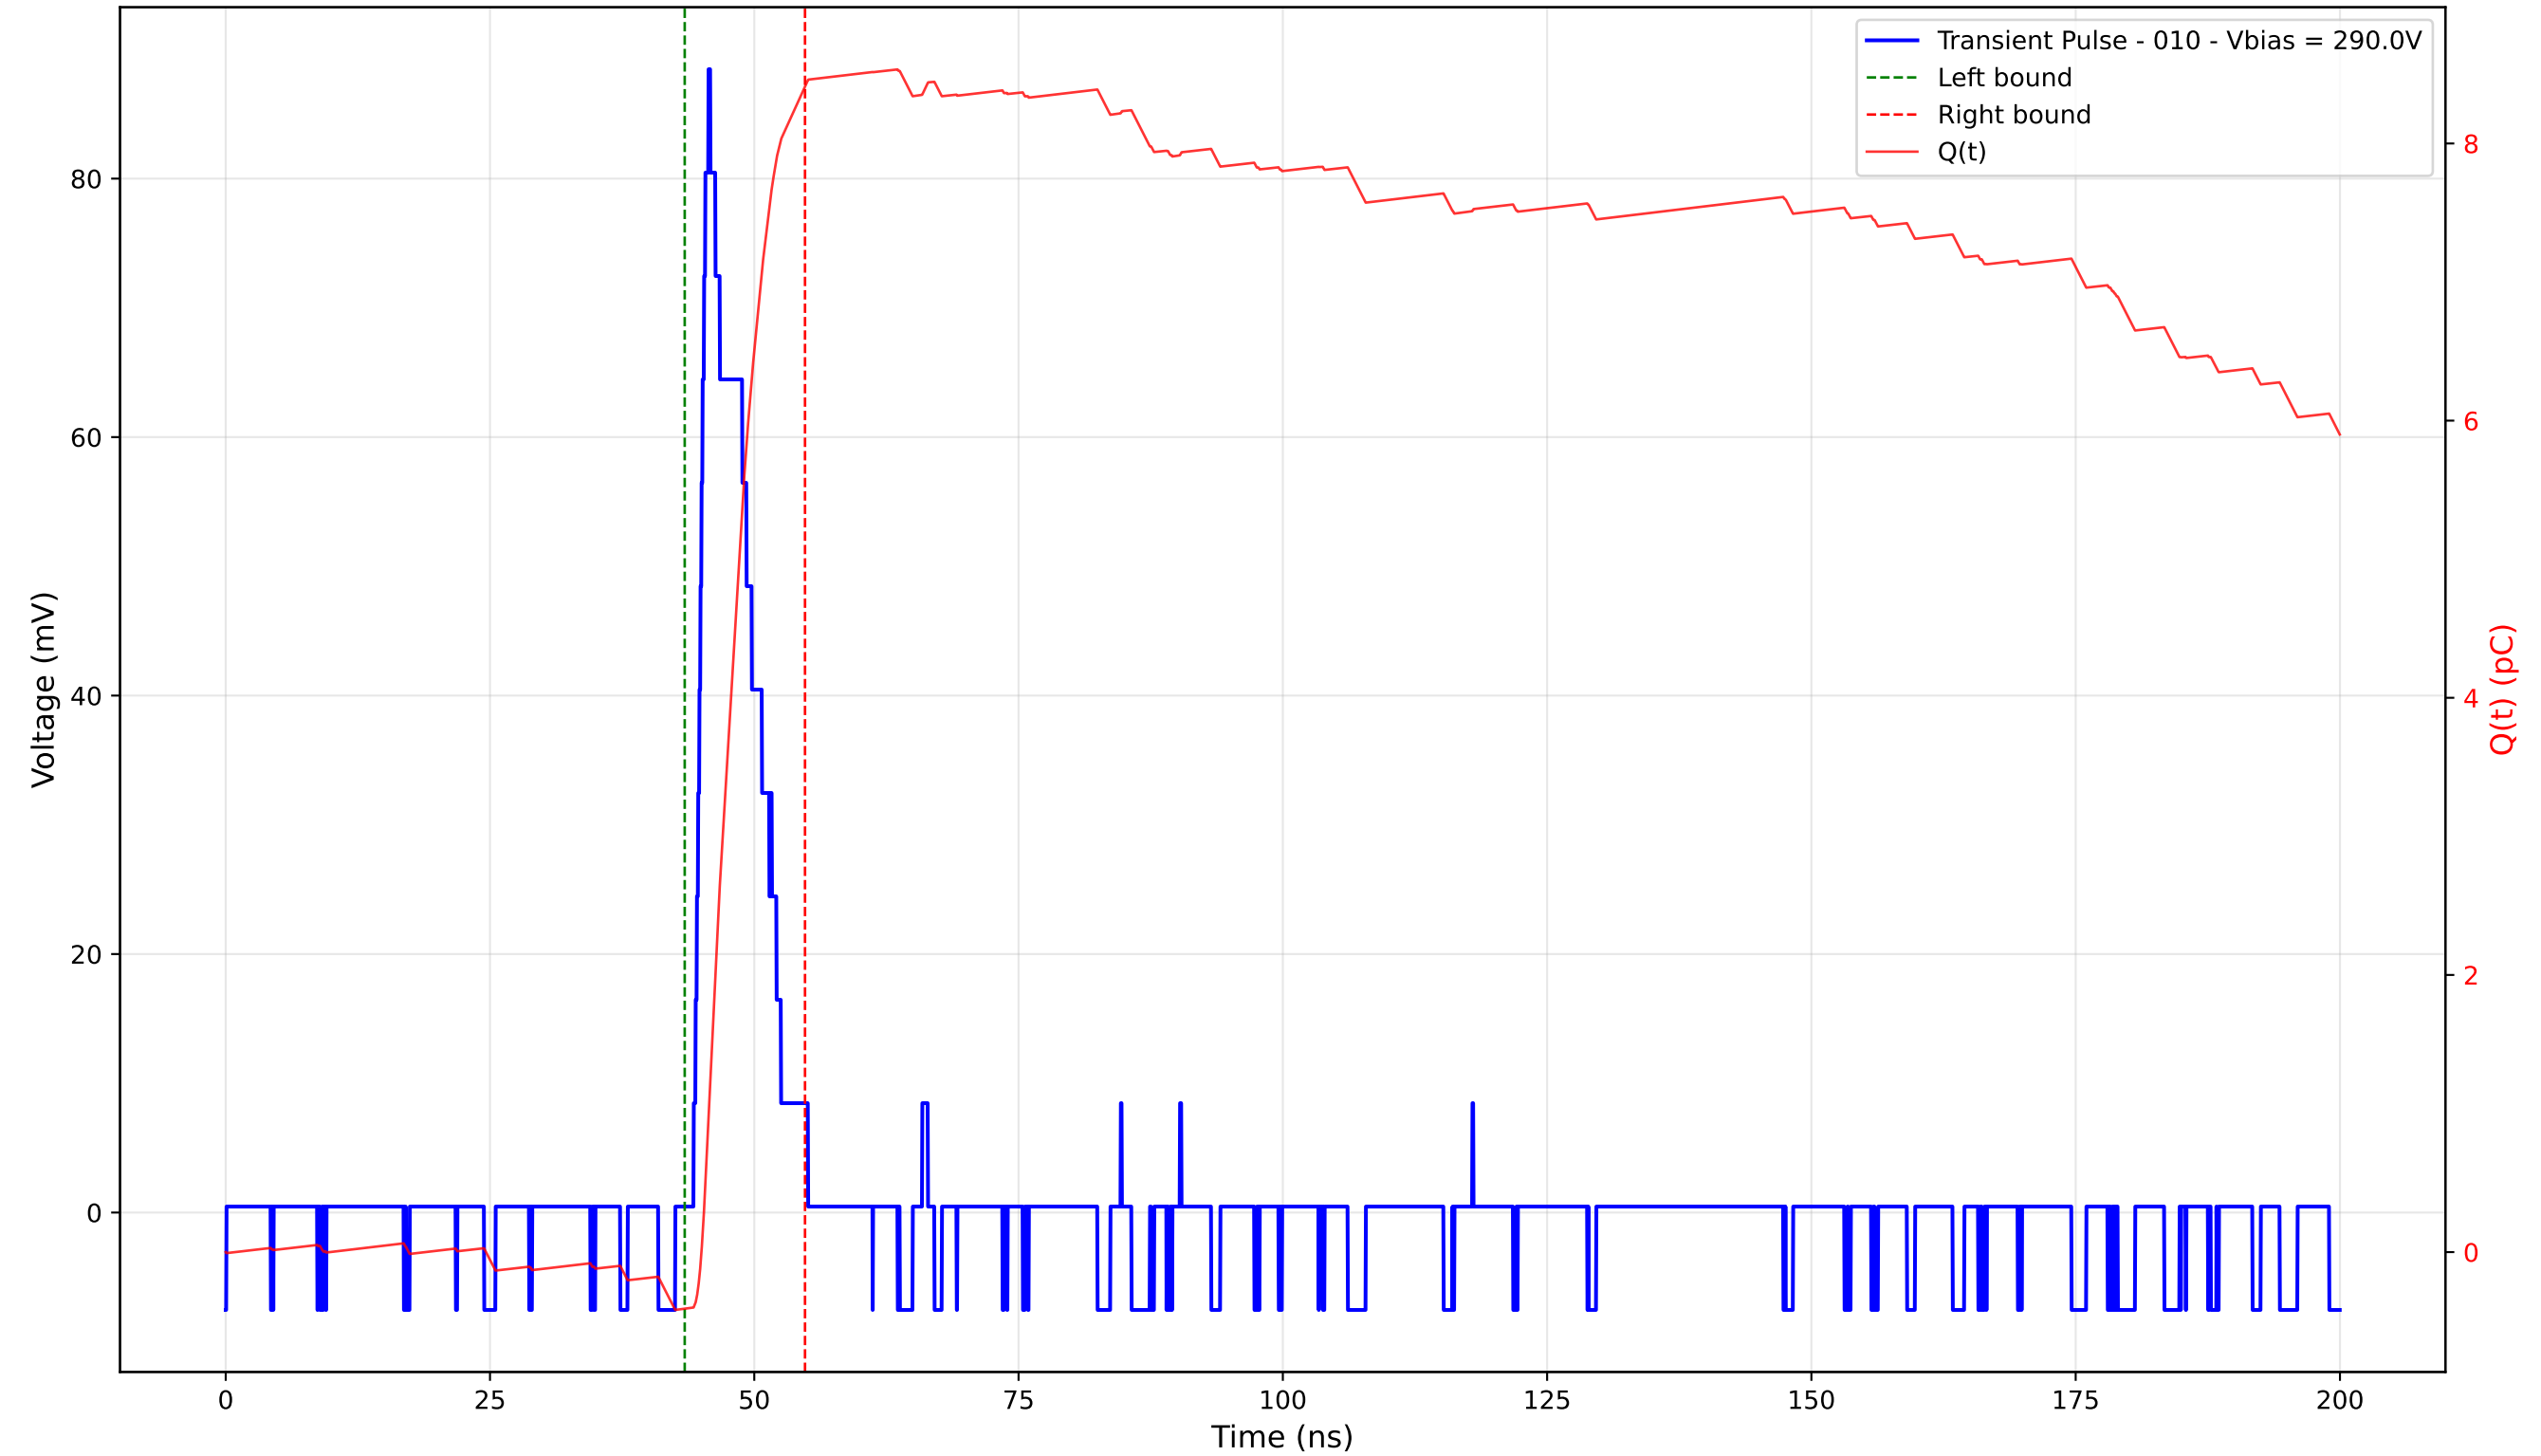


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 4.95 pC - Rise Time: 1.01 ns

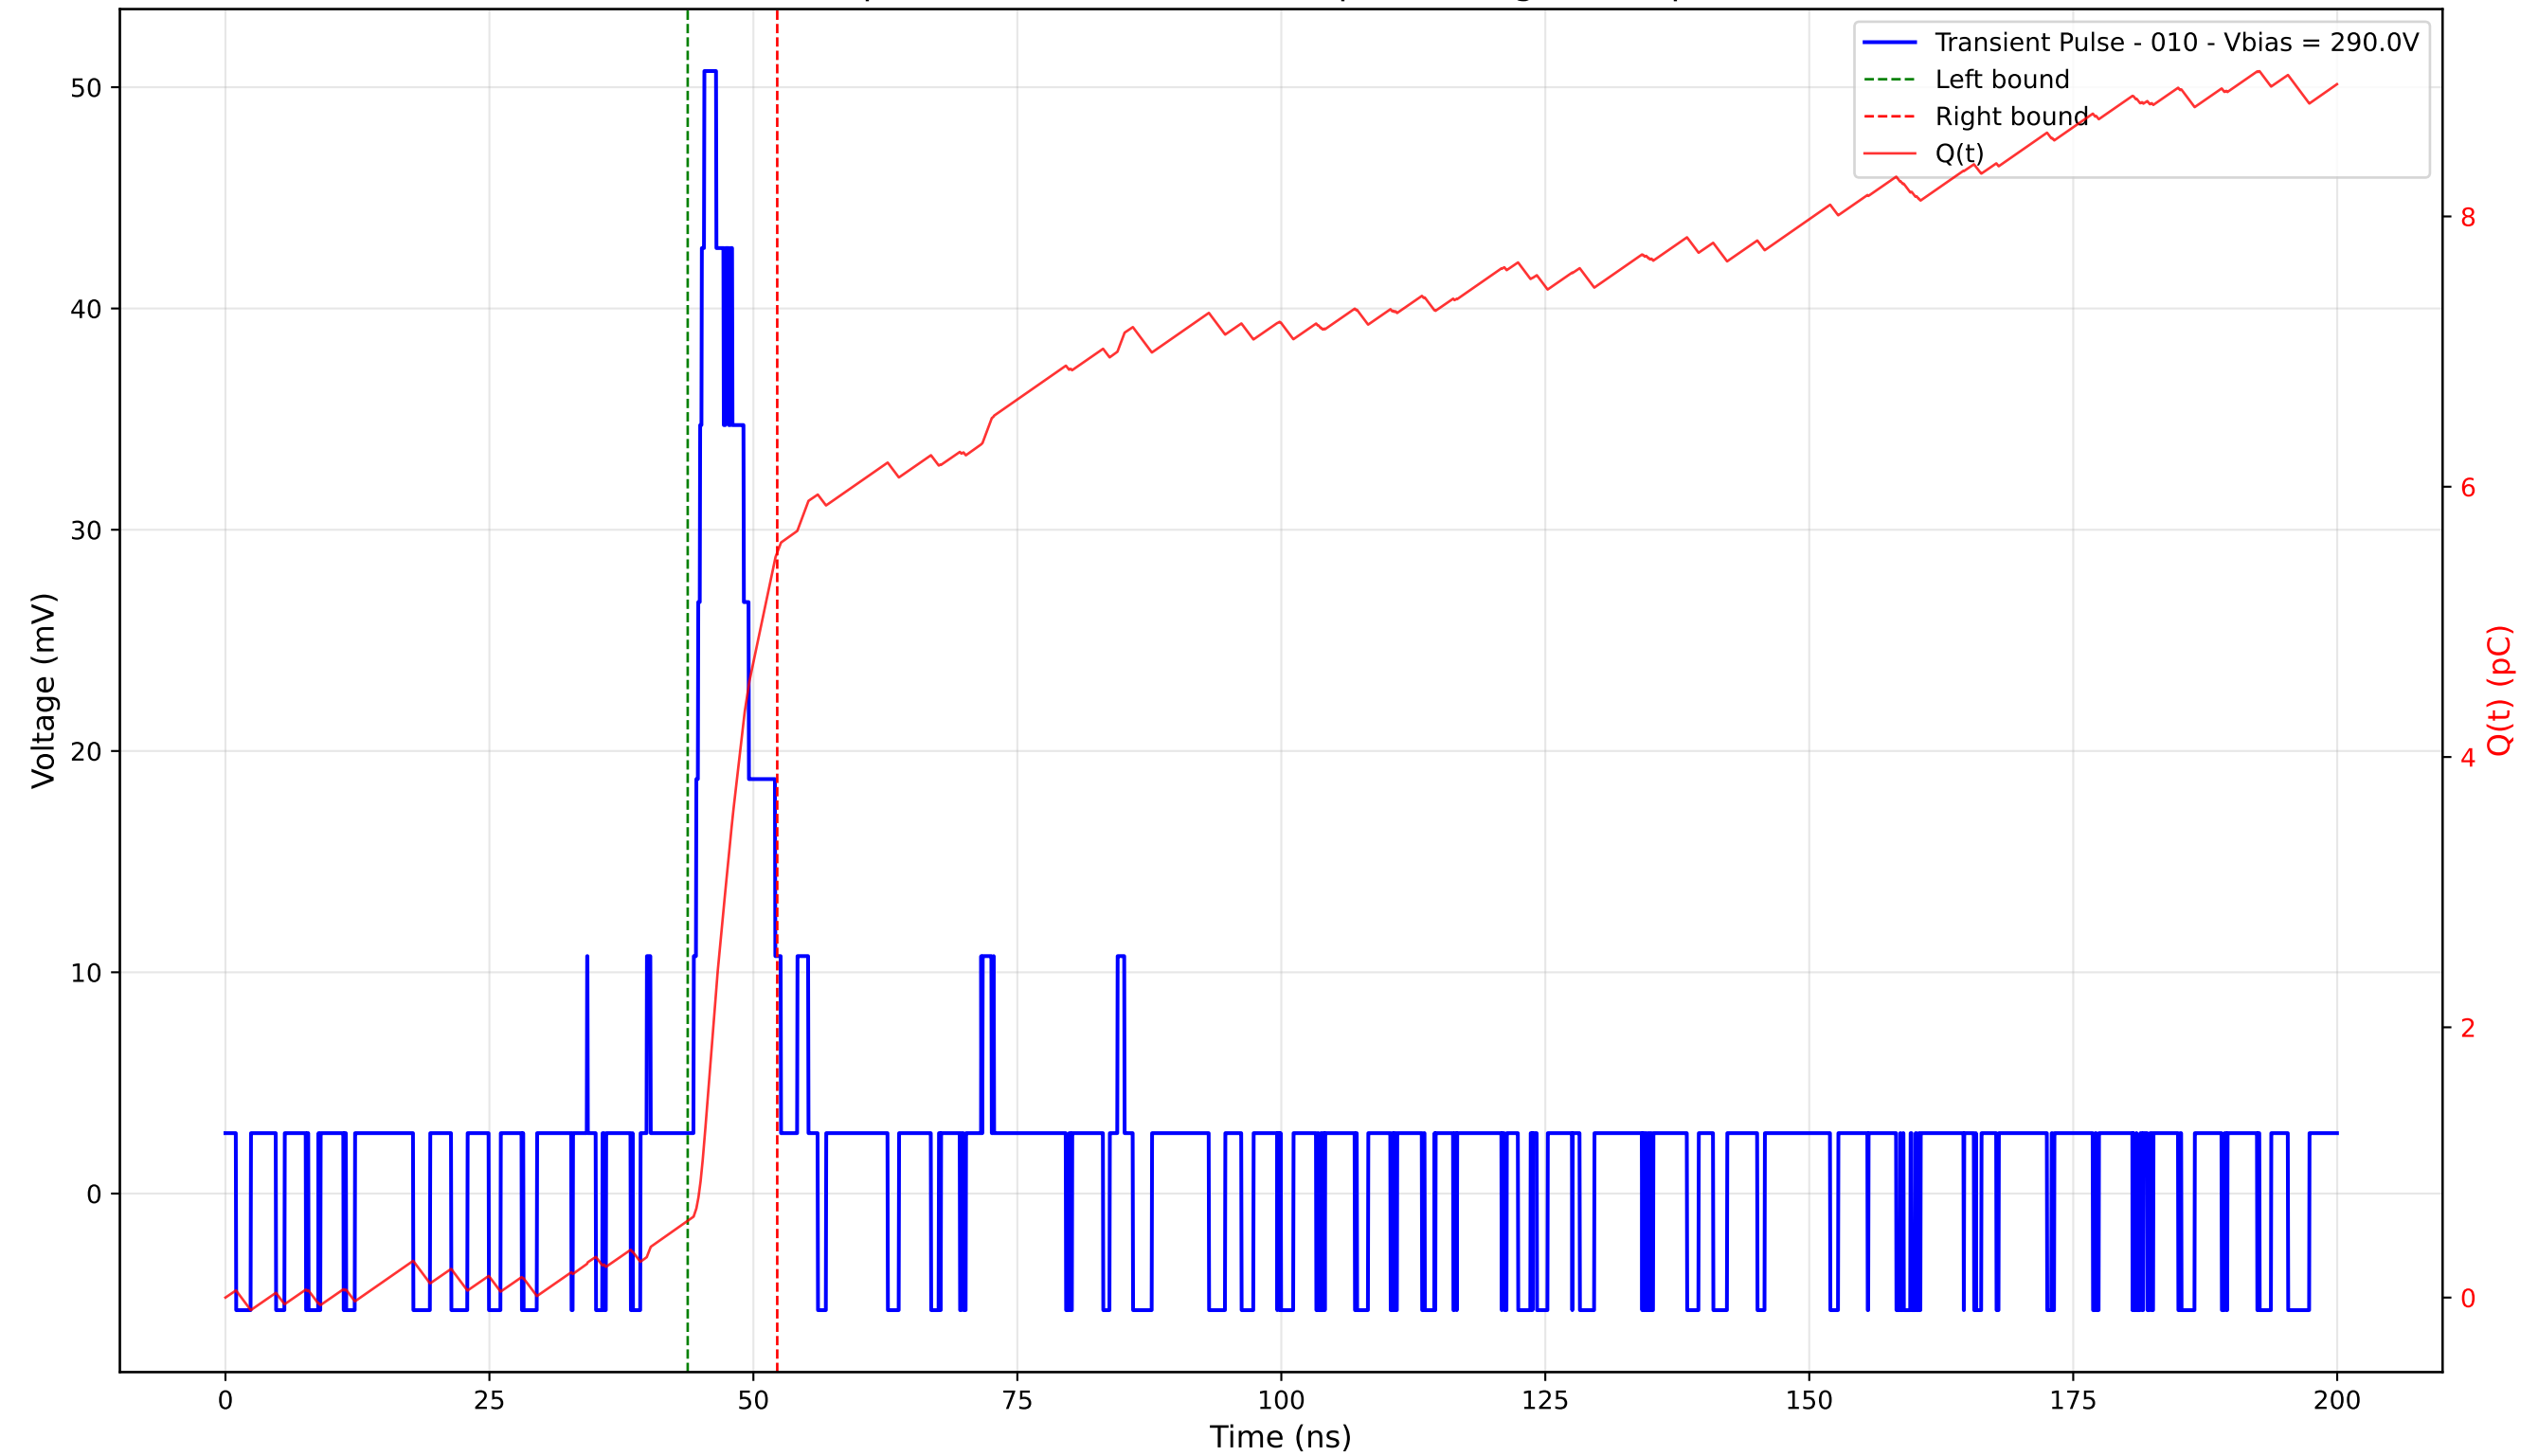

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.30 pC - Rise Time: 0.81 ns

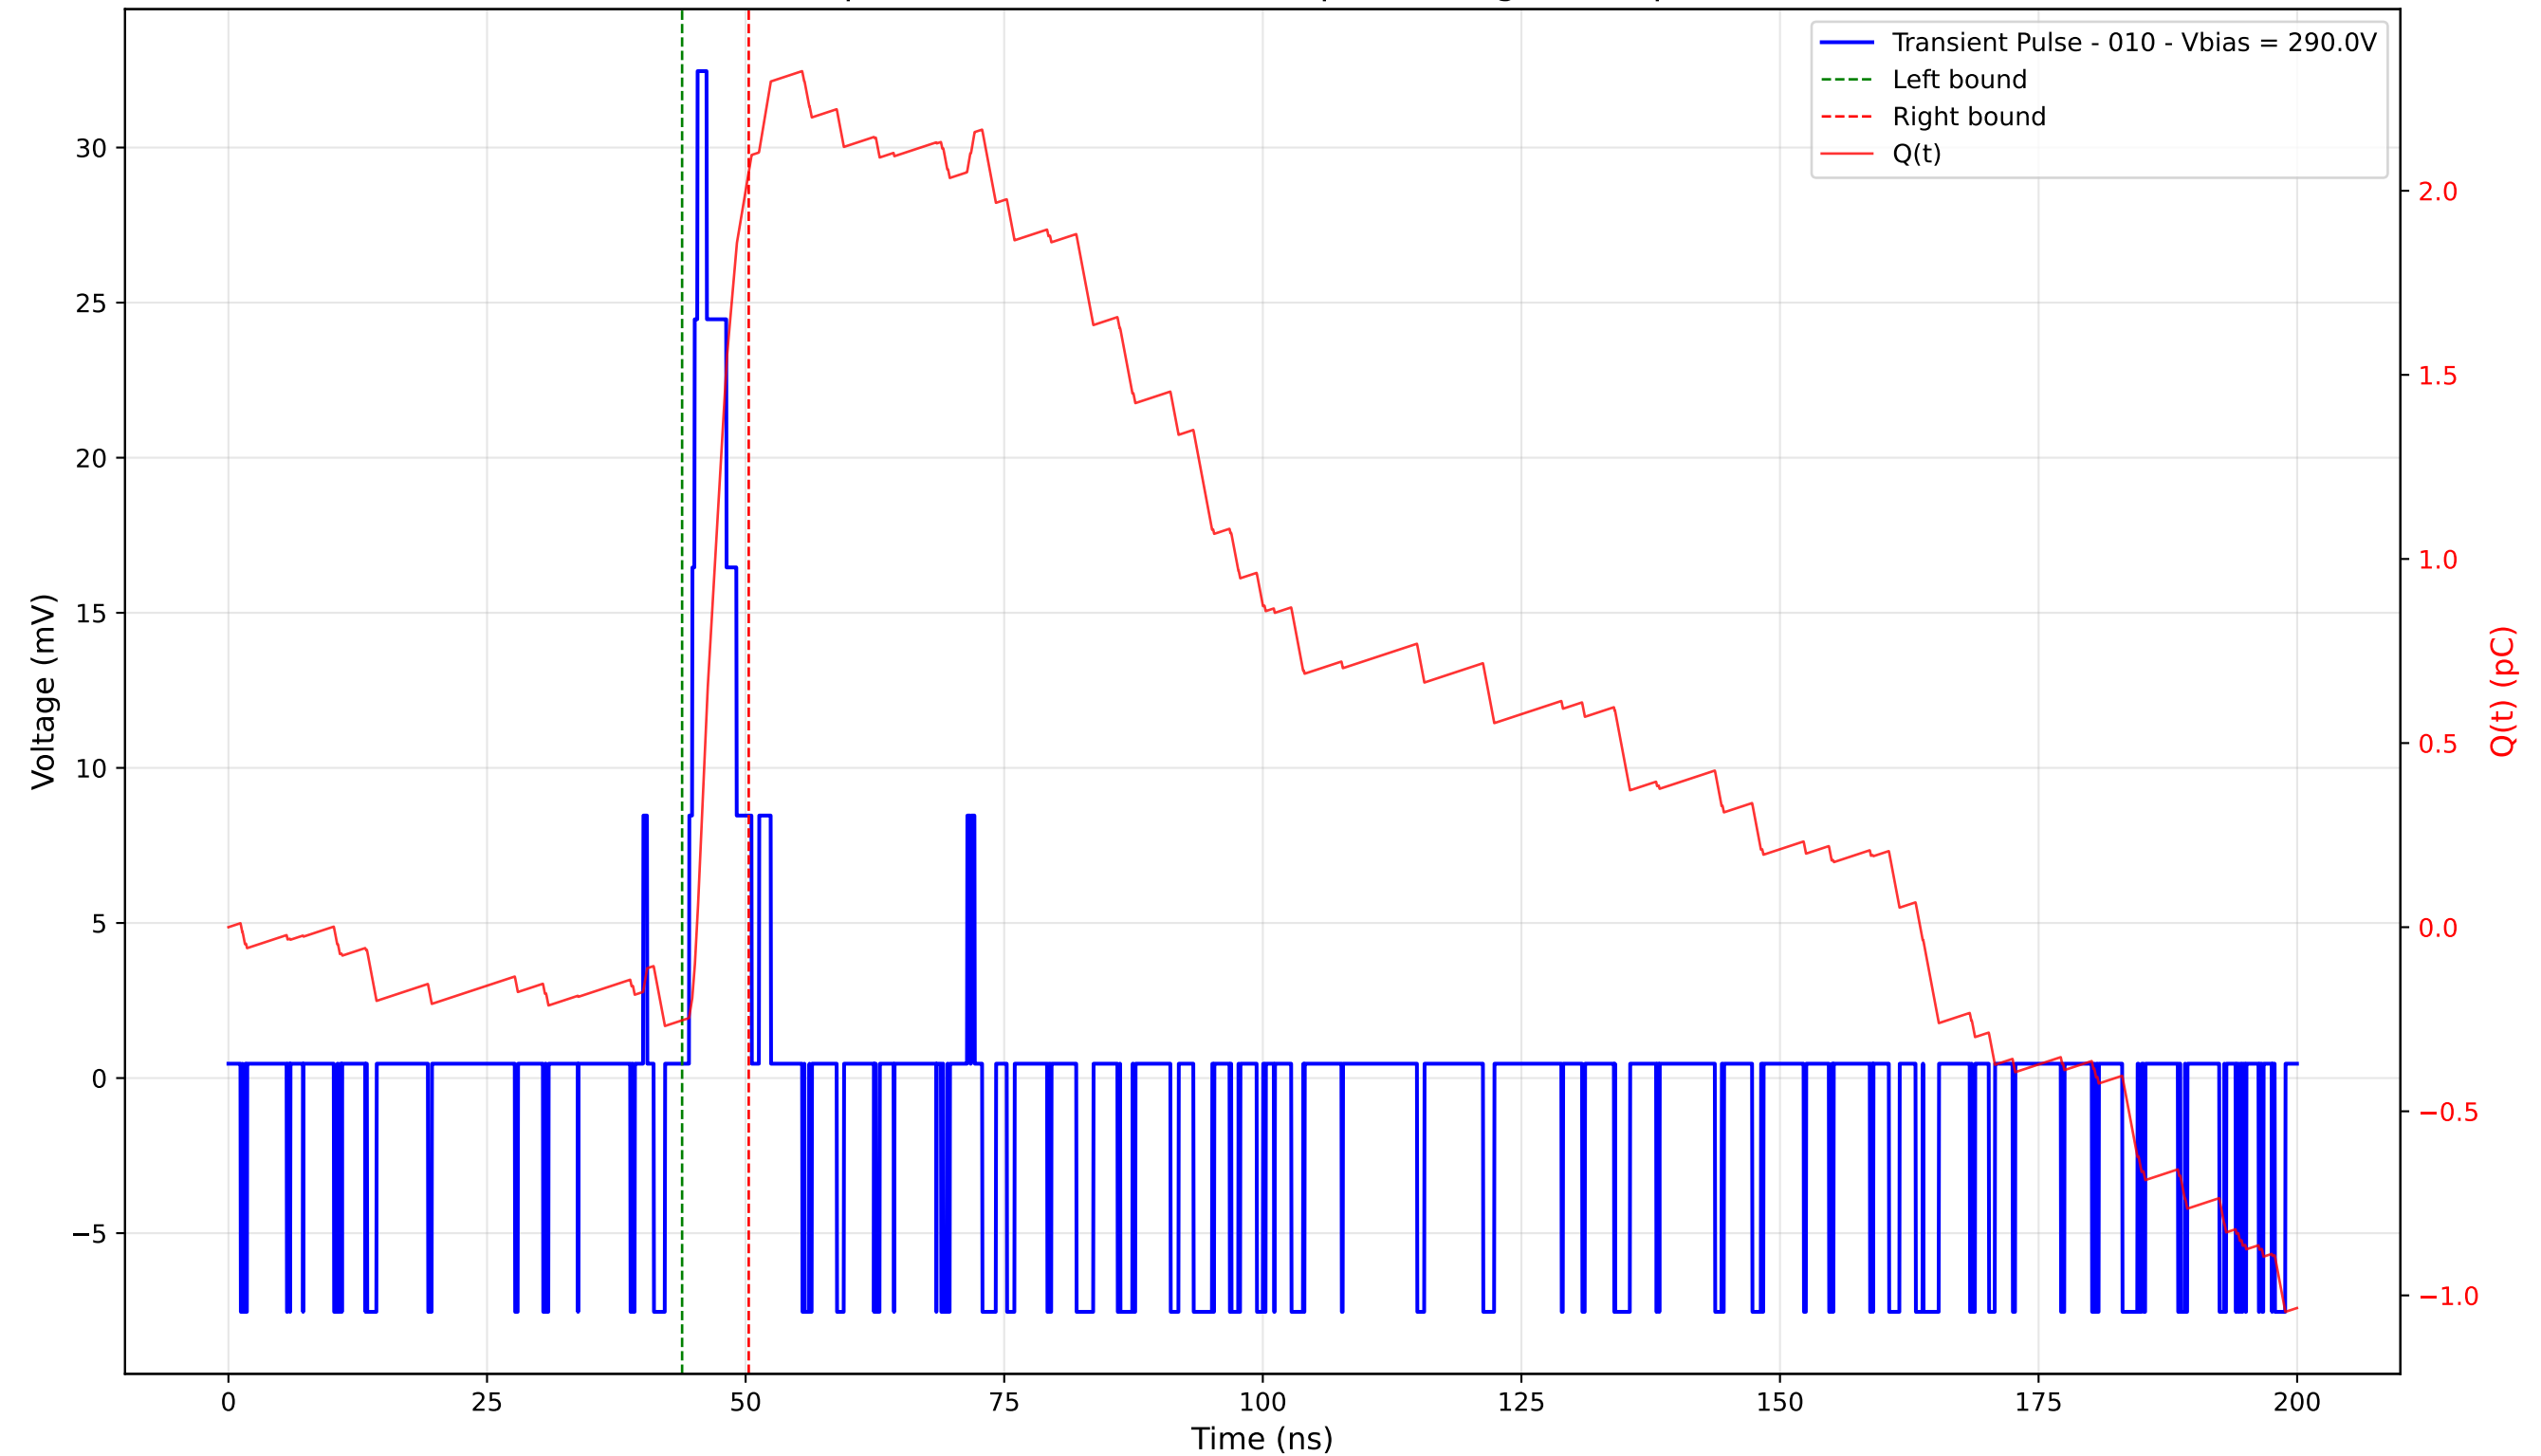

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 1.16 pC - Rise Time: 0.96 ns

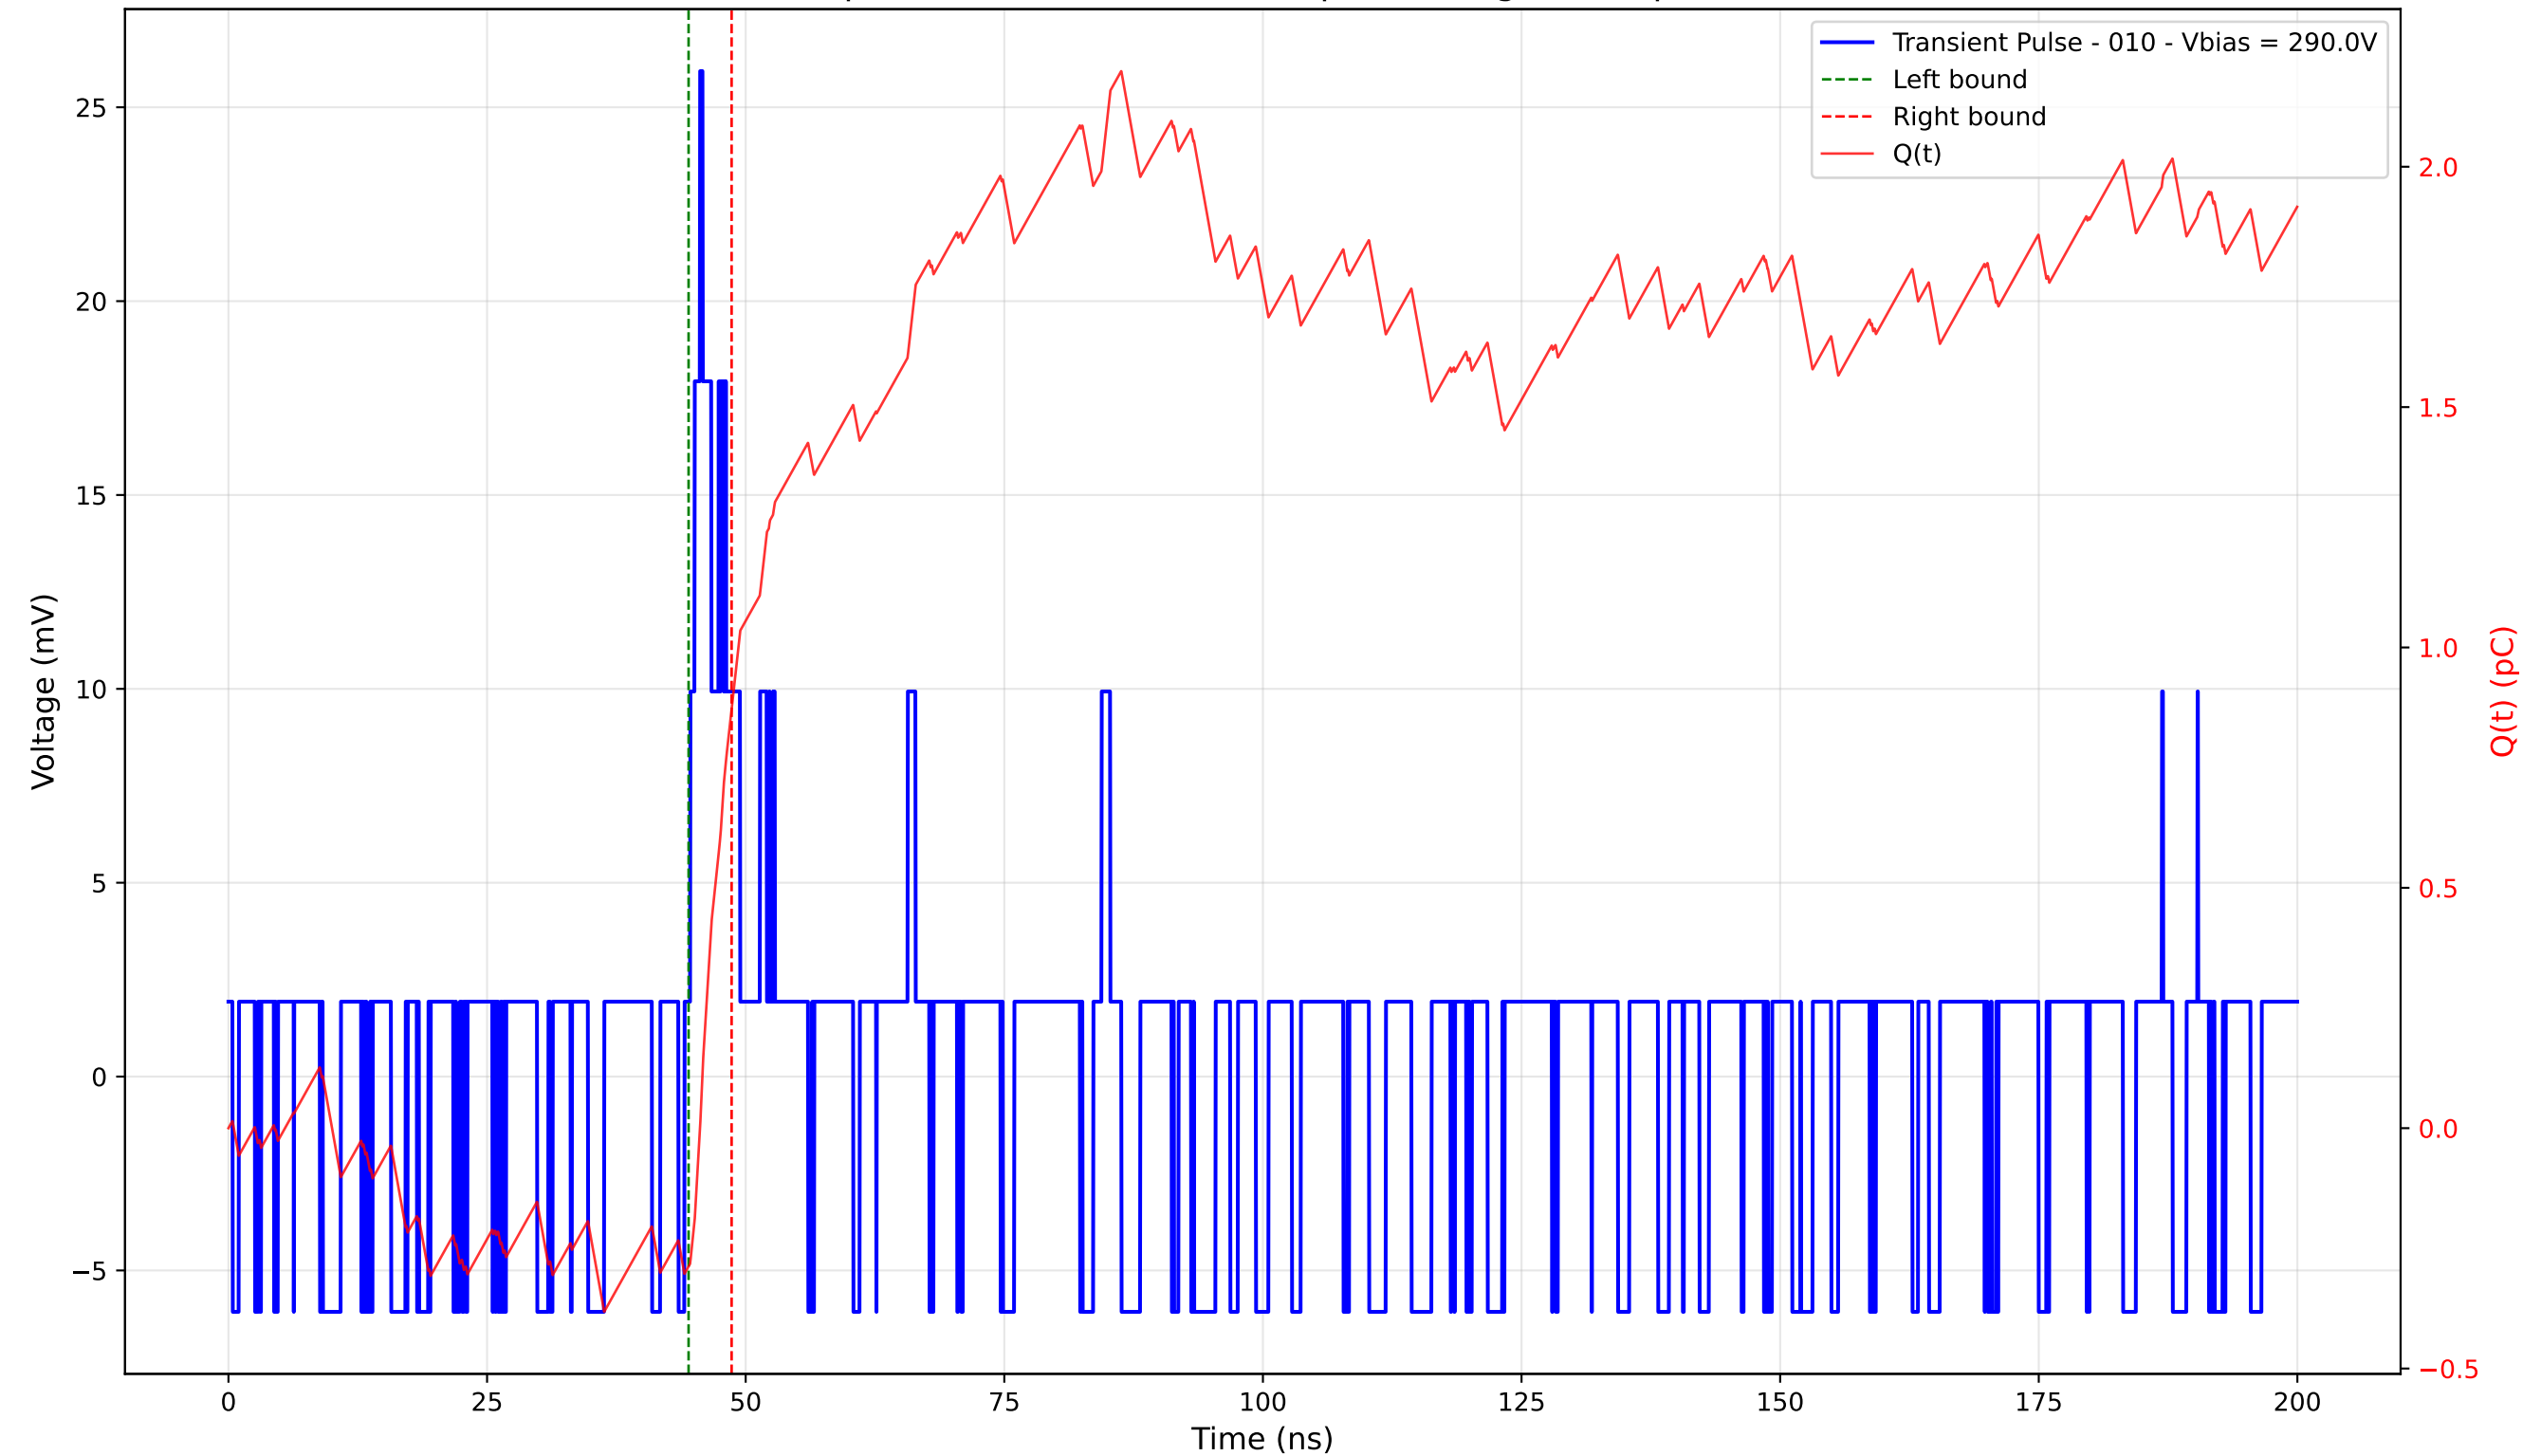

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.64 pC - Rise Time: 0.38 ns

