


TCT Run 011 Summary

Parameter	Value
Run	Run011
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	270.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\270V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

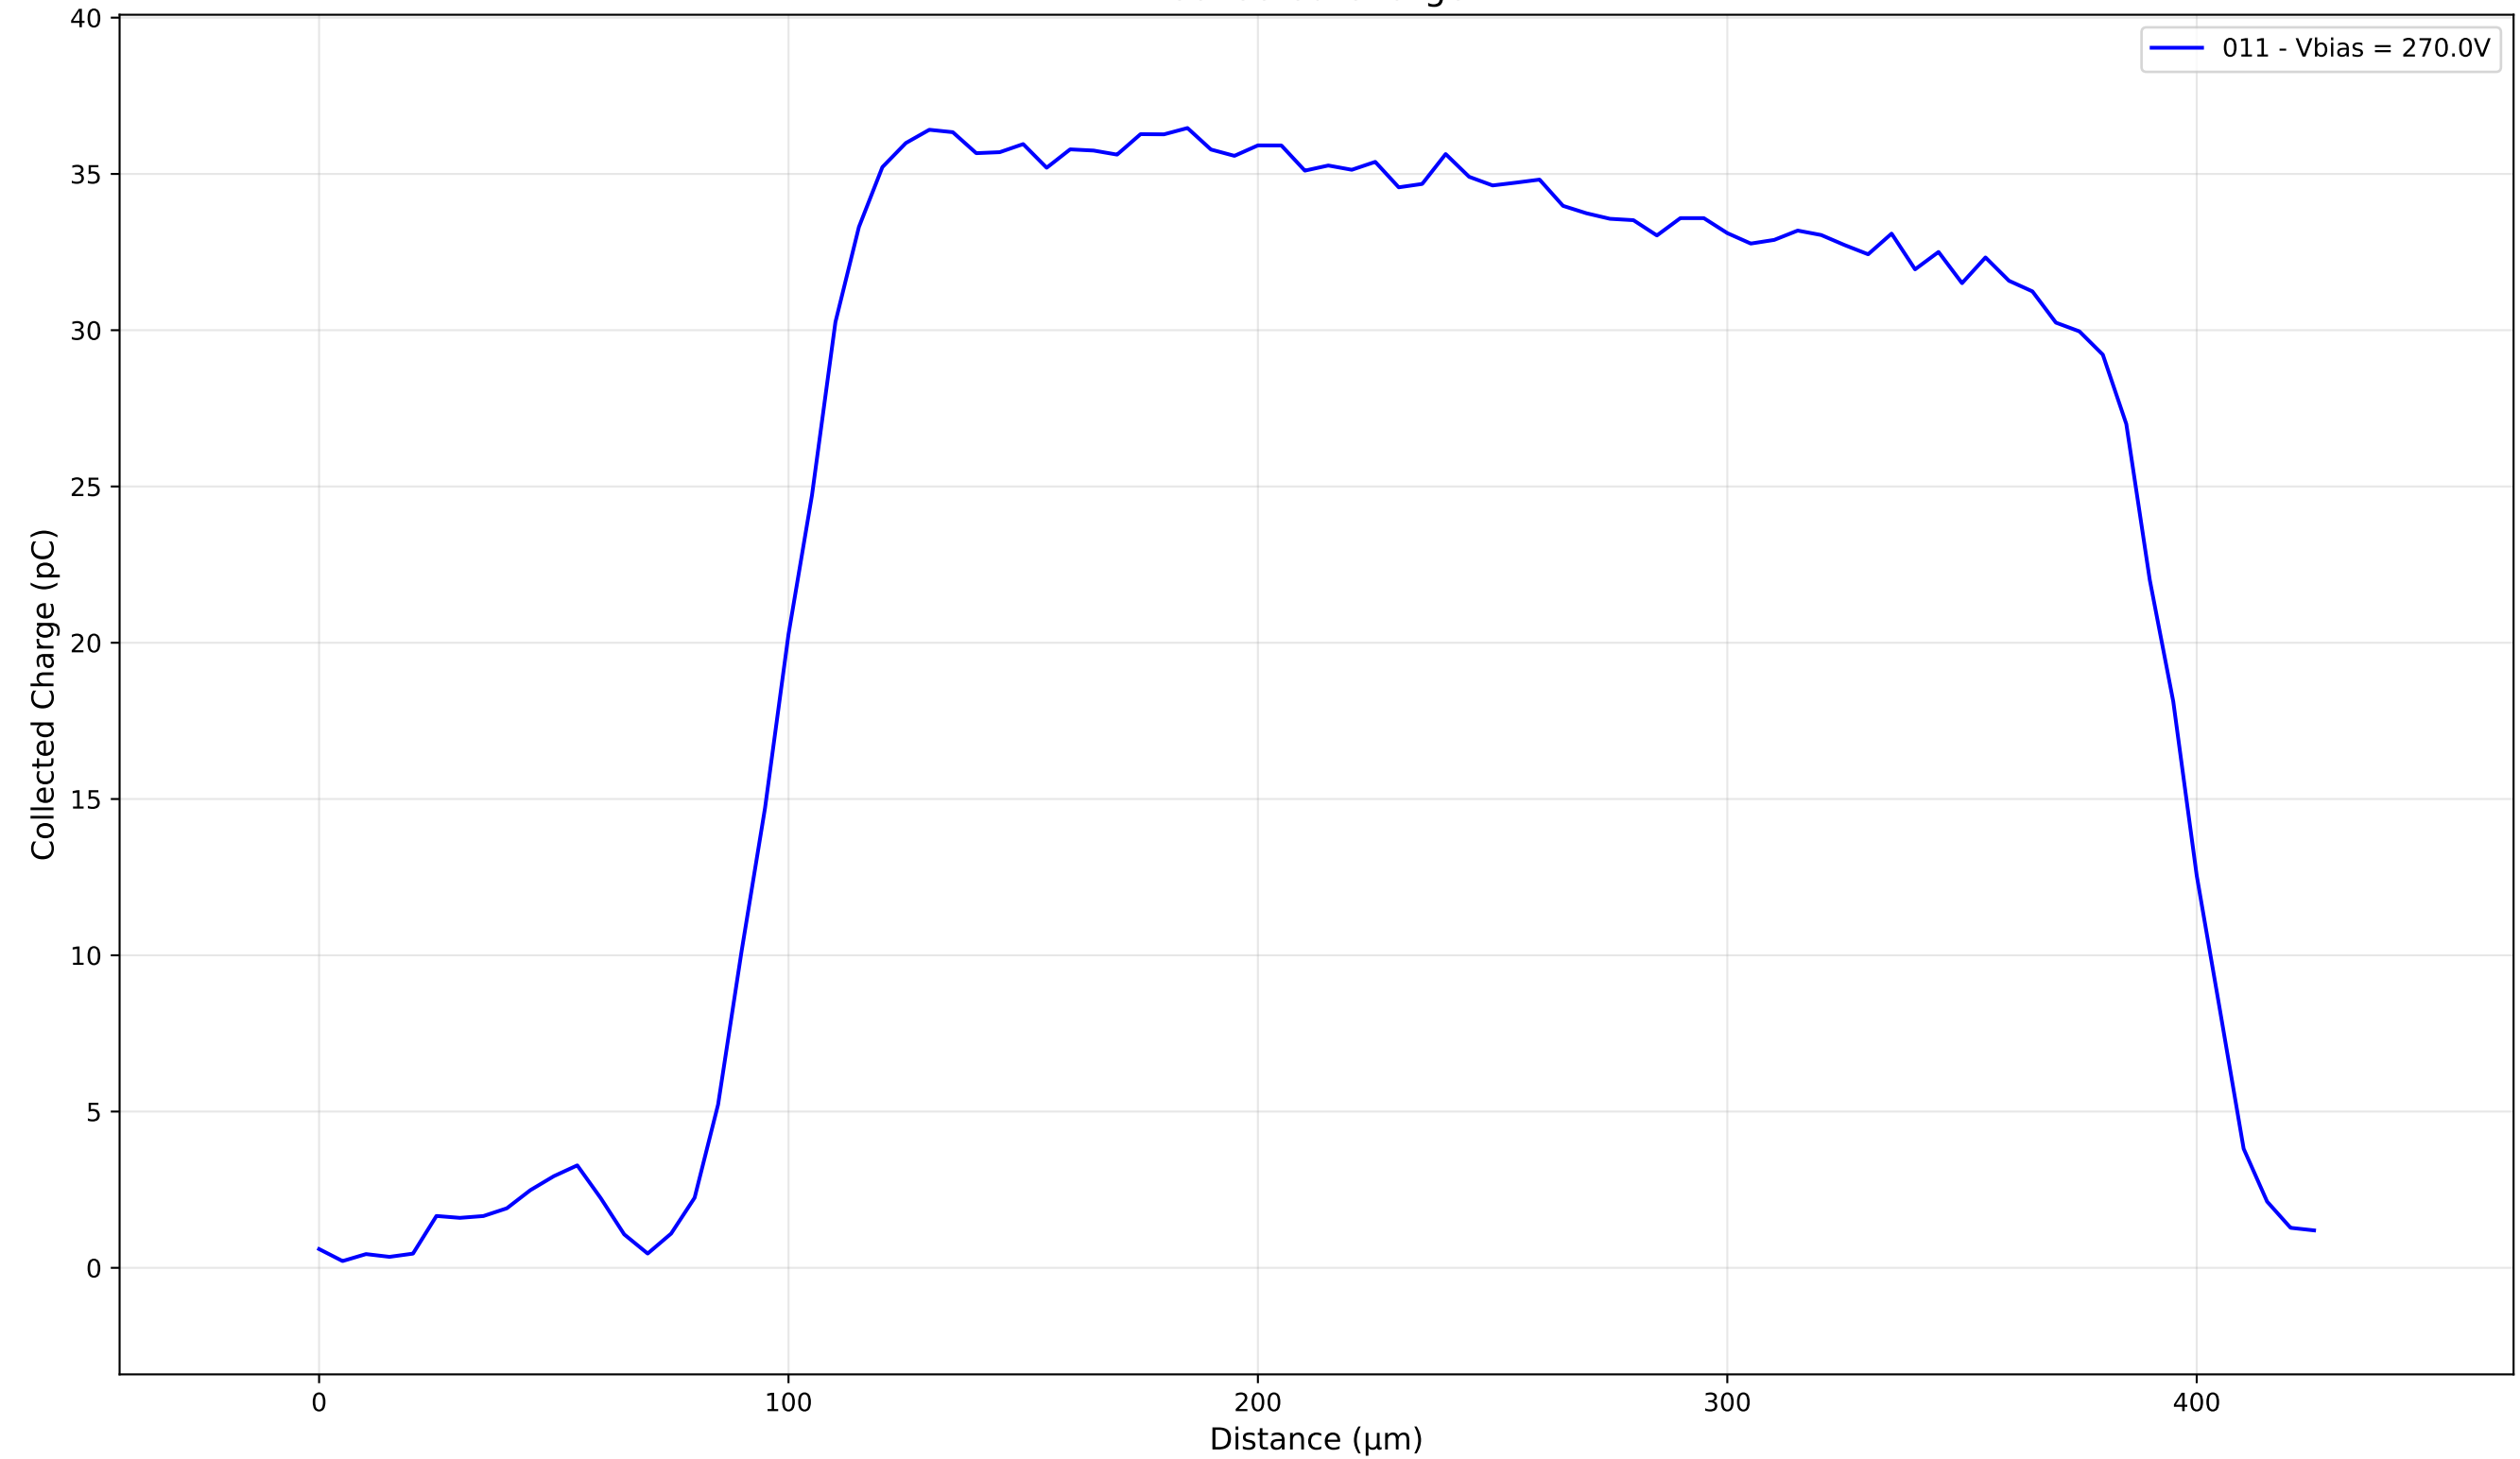

Collected Charge

011 - Vbias = 270.0V

Collected Charge [a.u.]

1.0

0.8

0.6

0.4

0.2

0.0

0


100

200


300

400


Distance (μm)

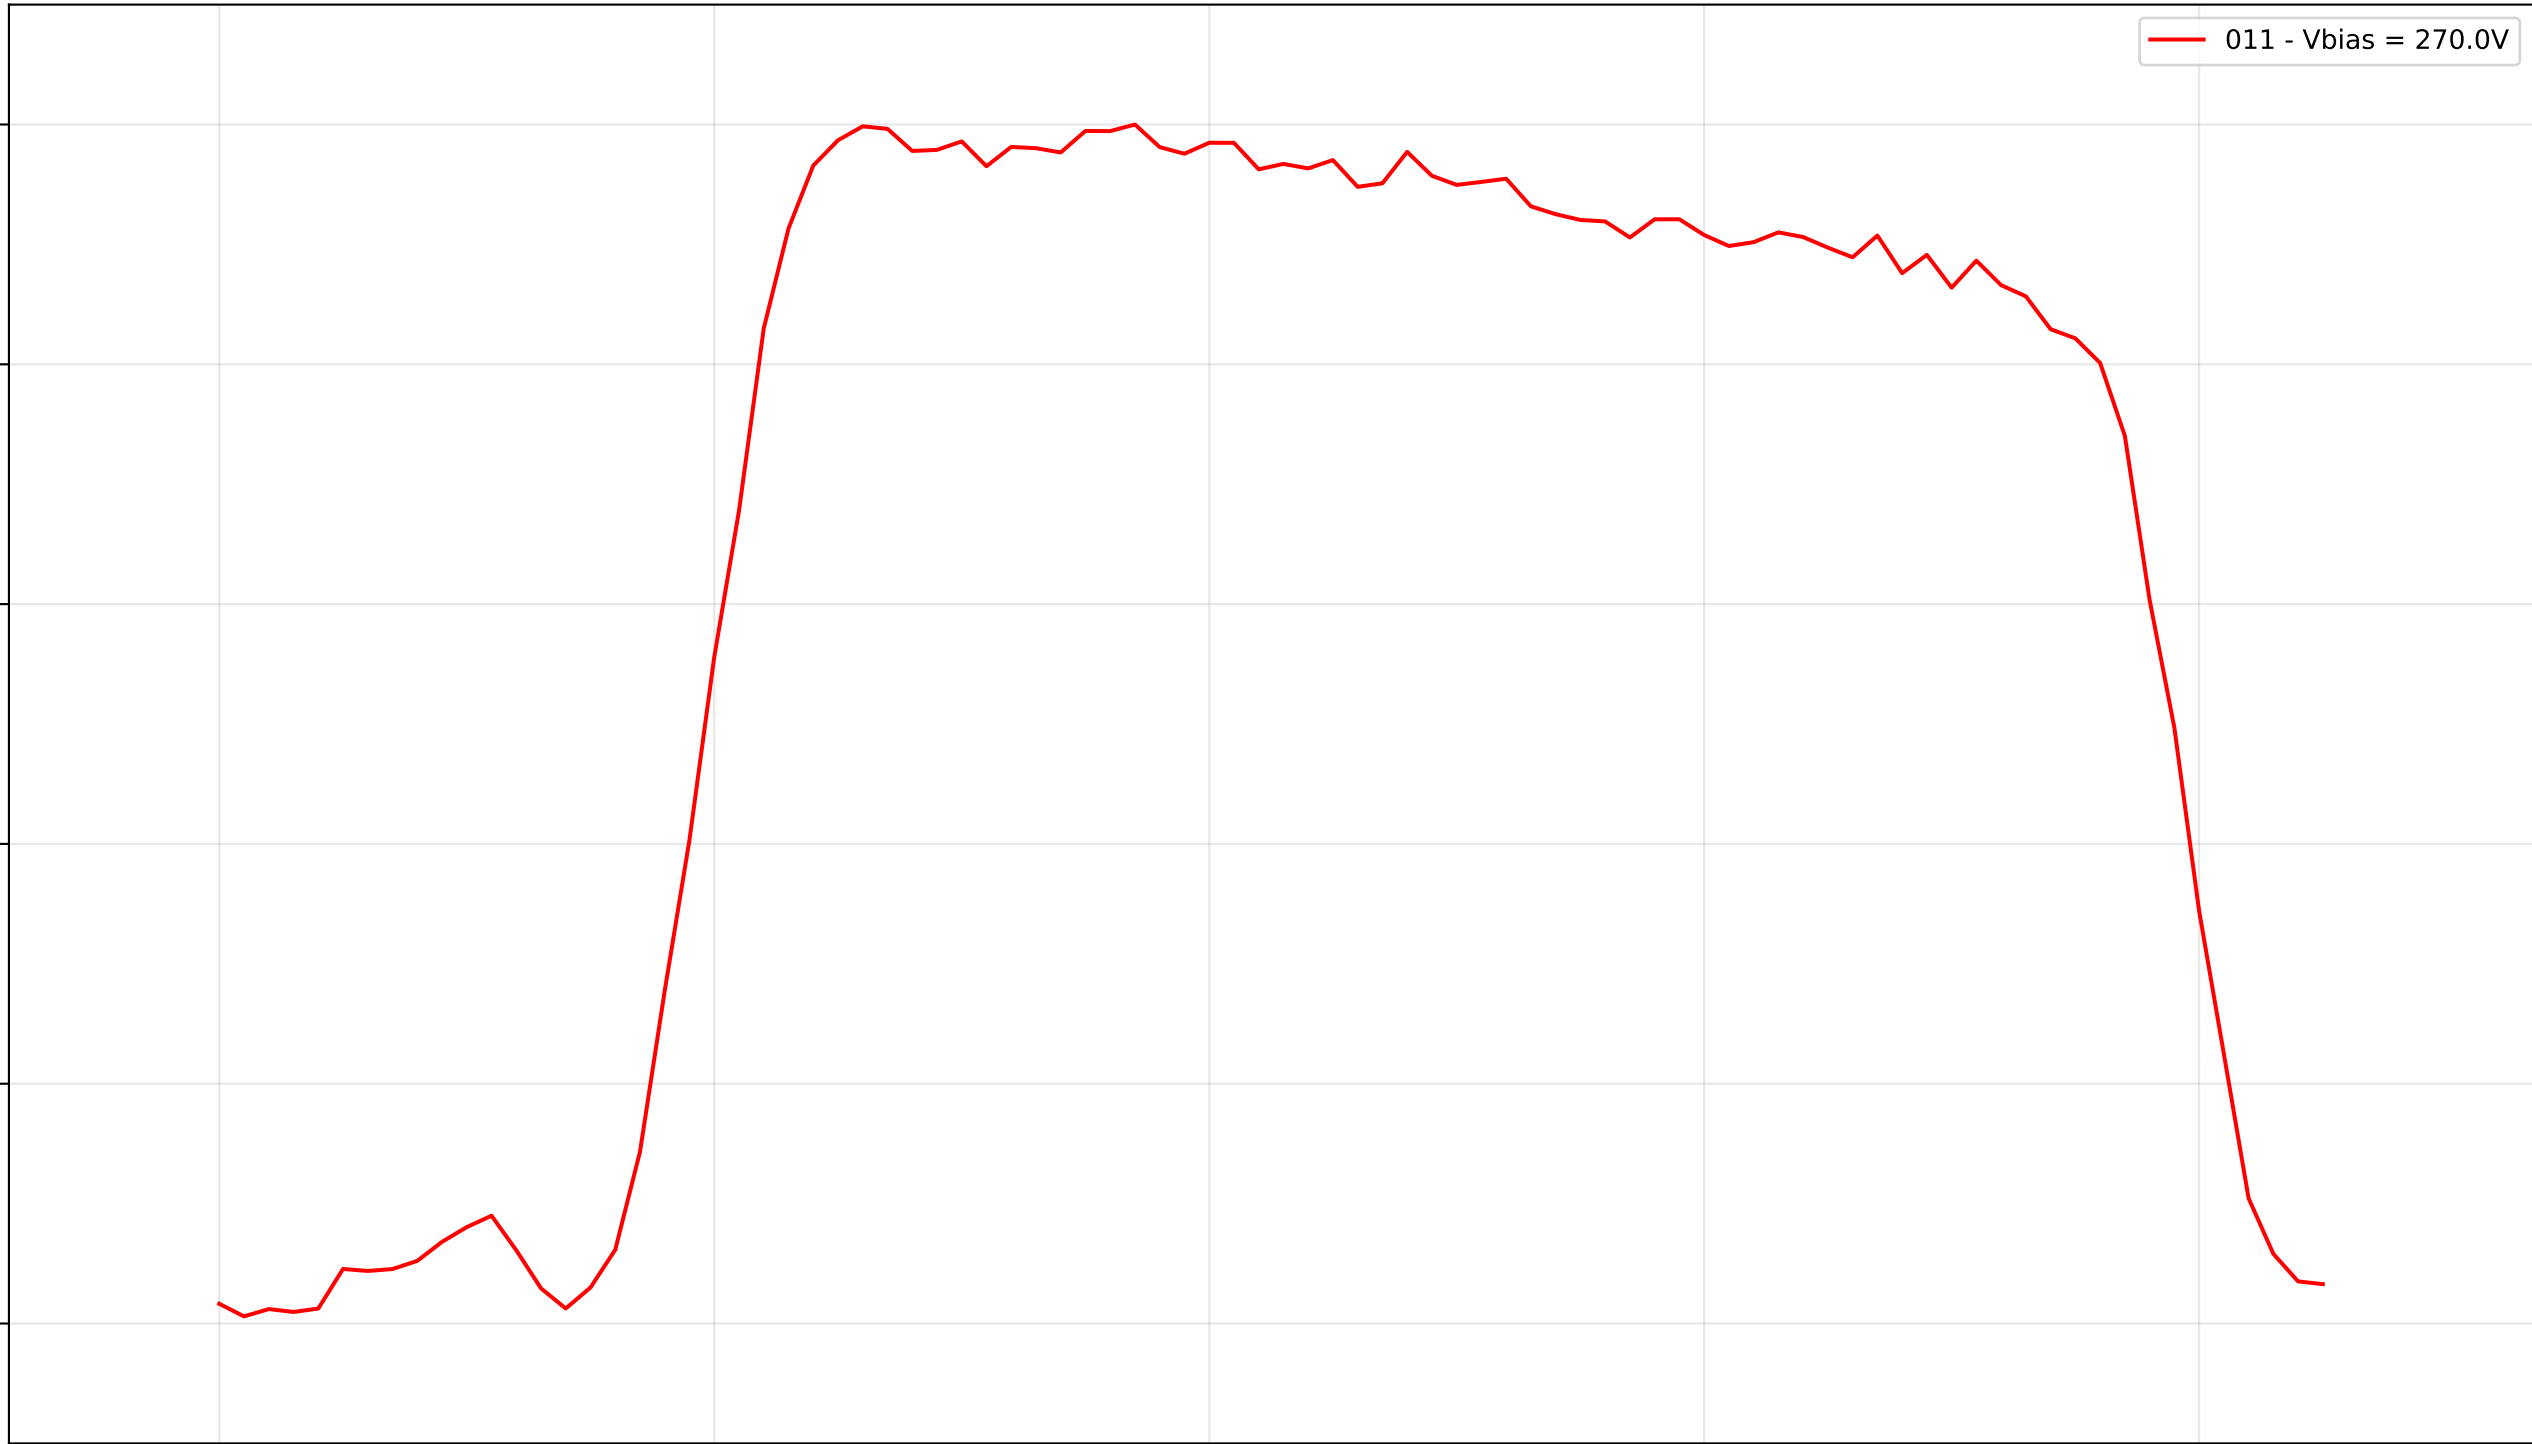


Rise Time

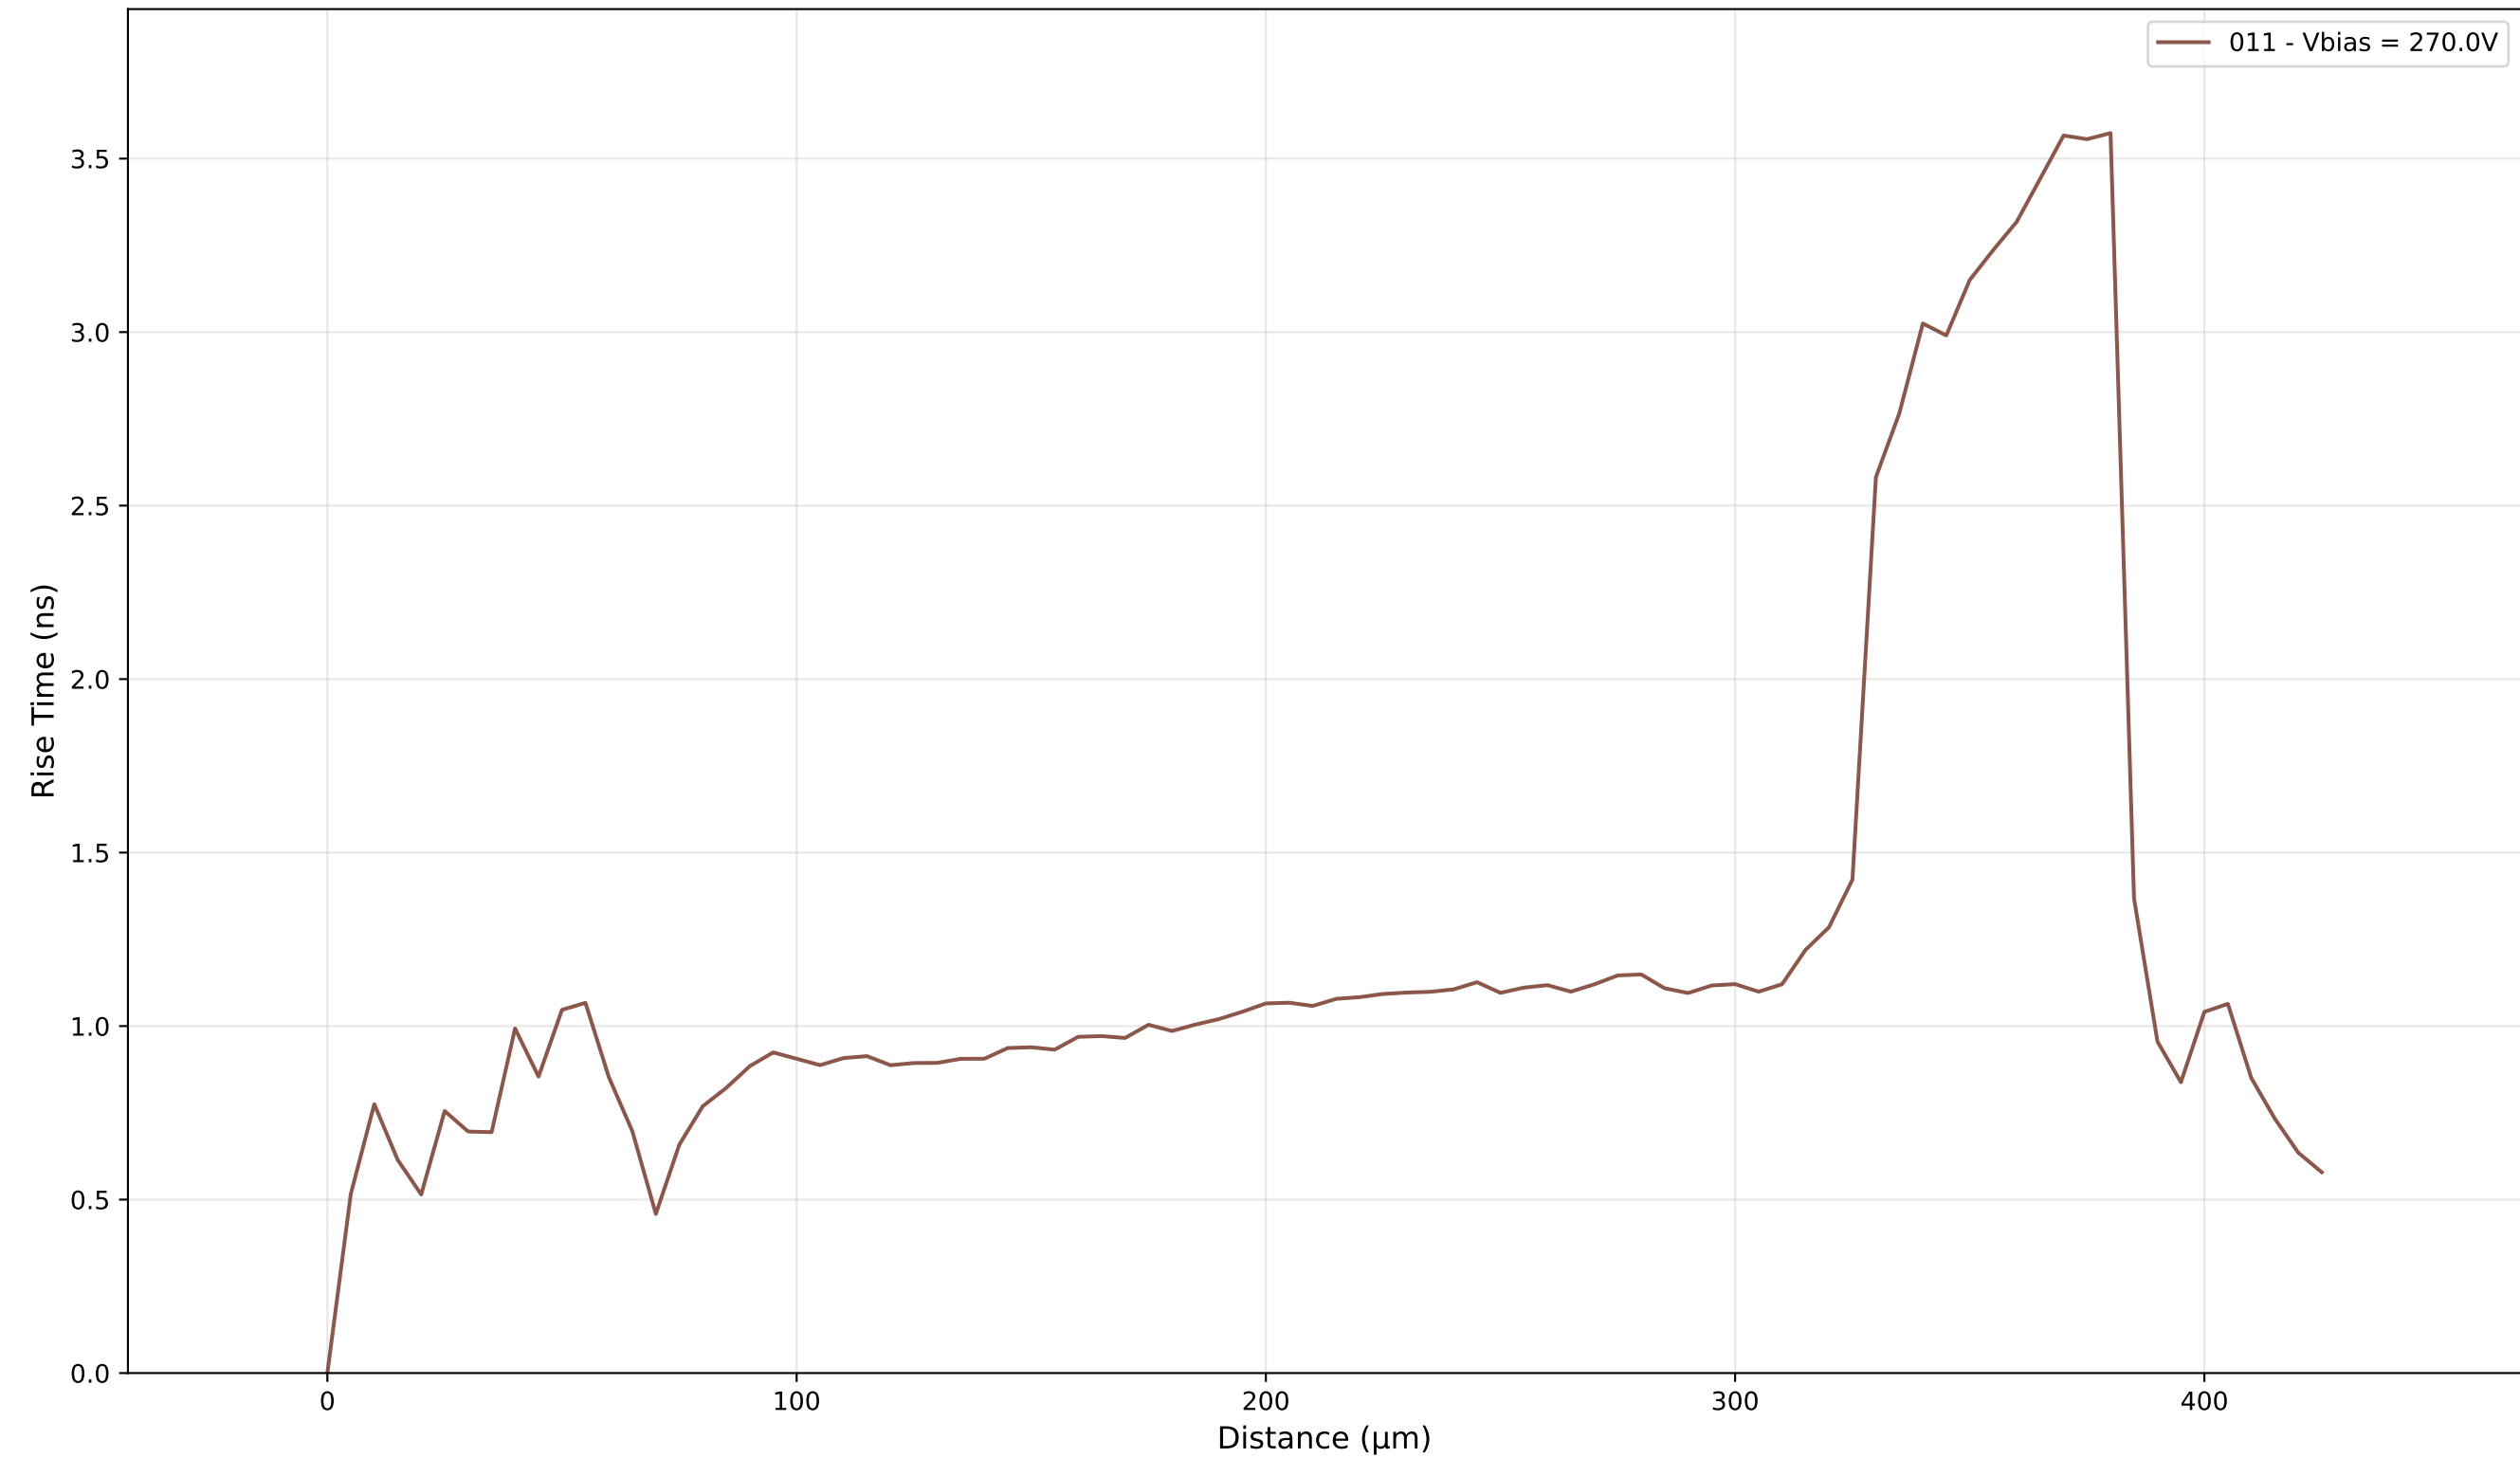


Amplitude

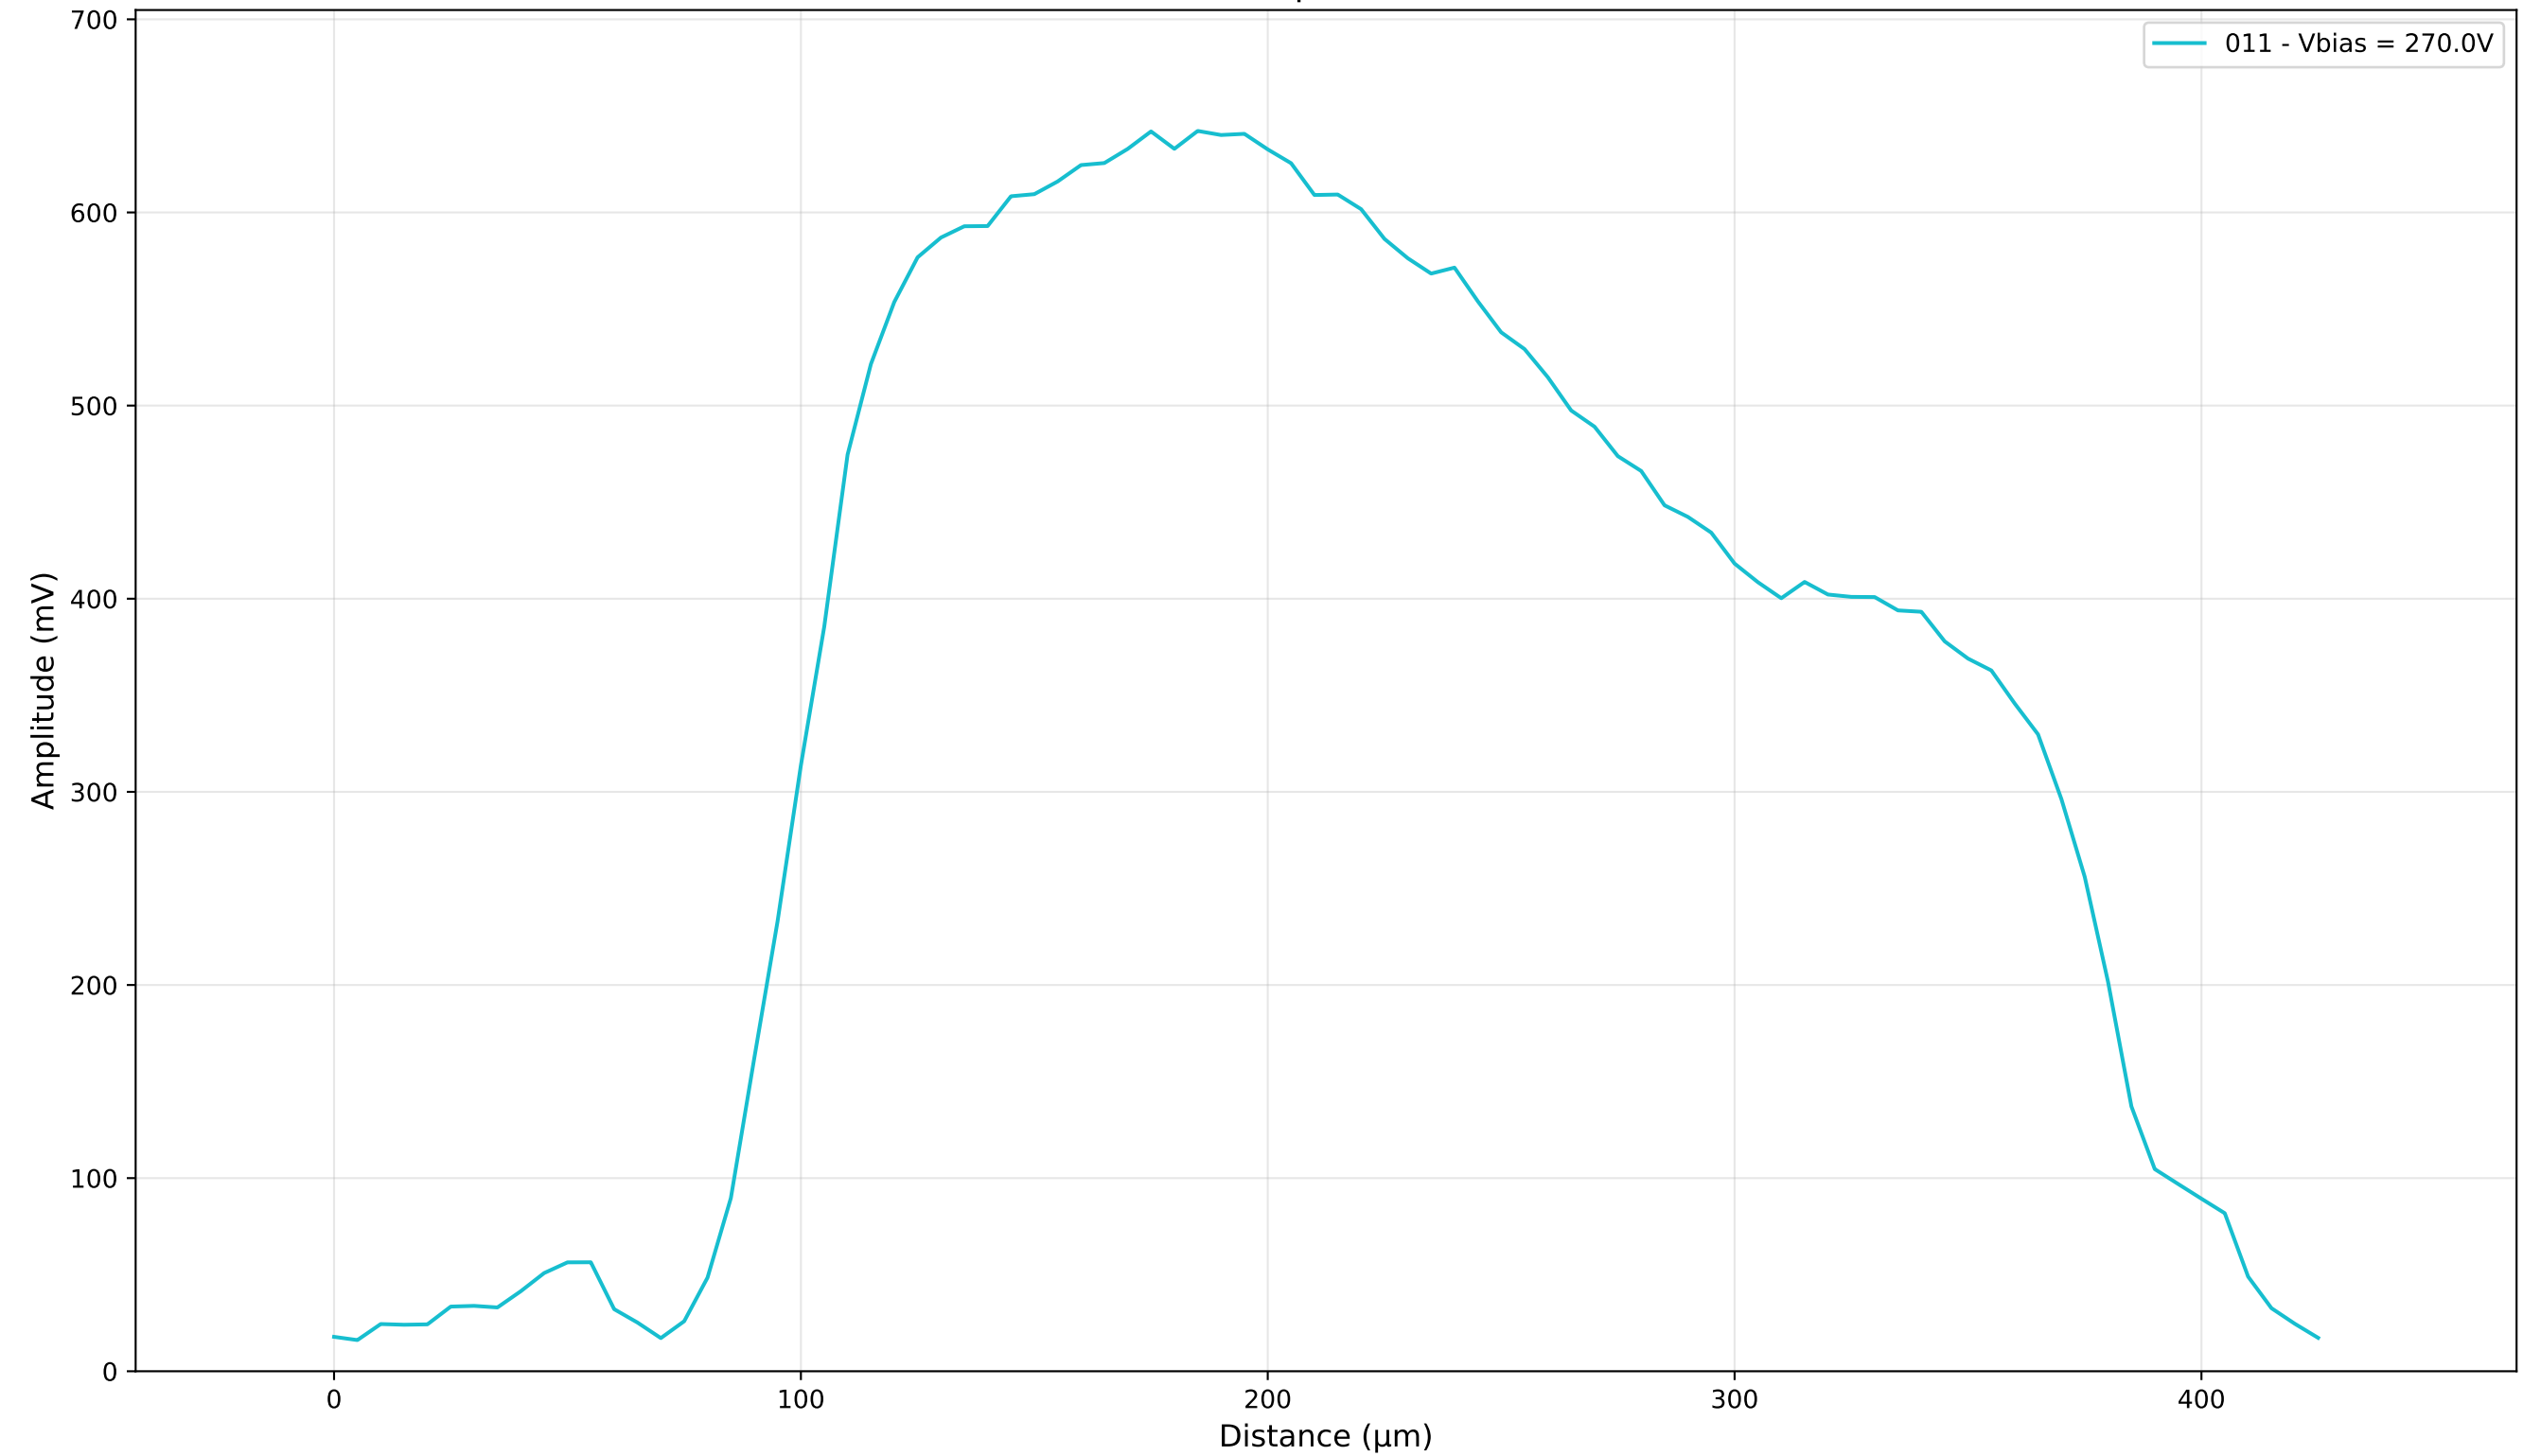


FWHM

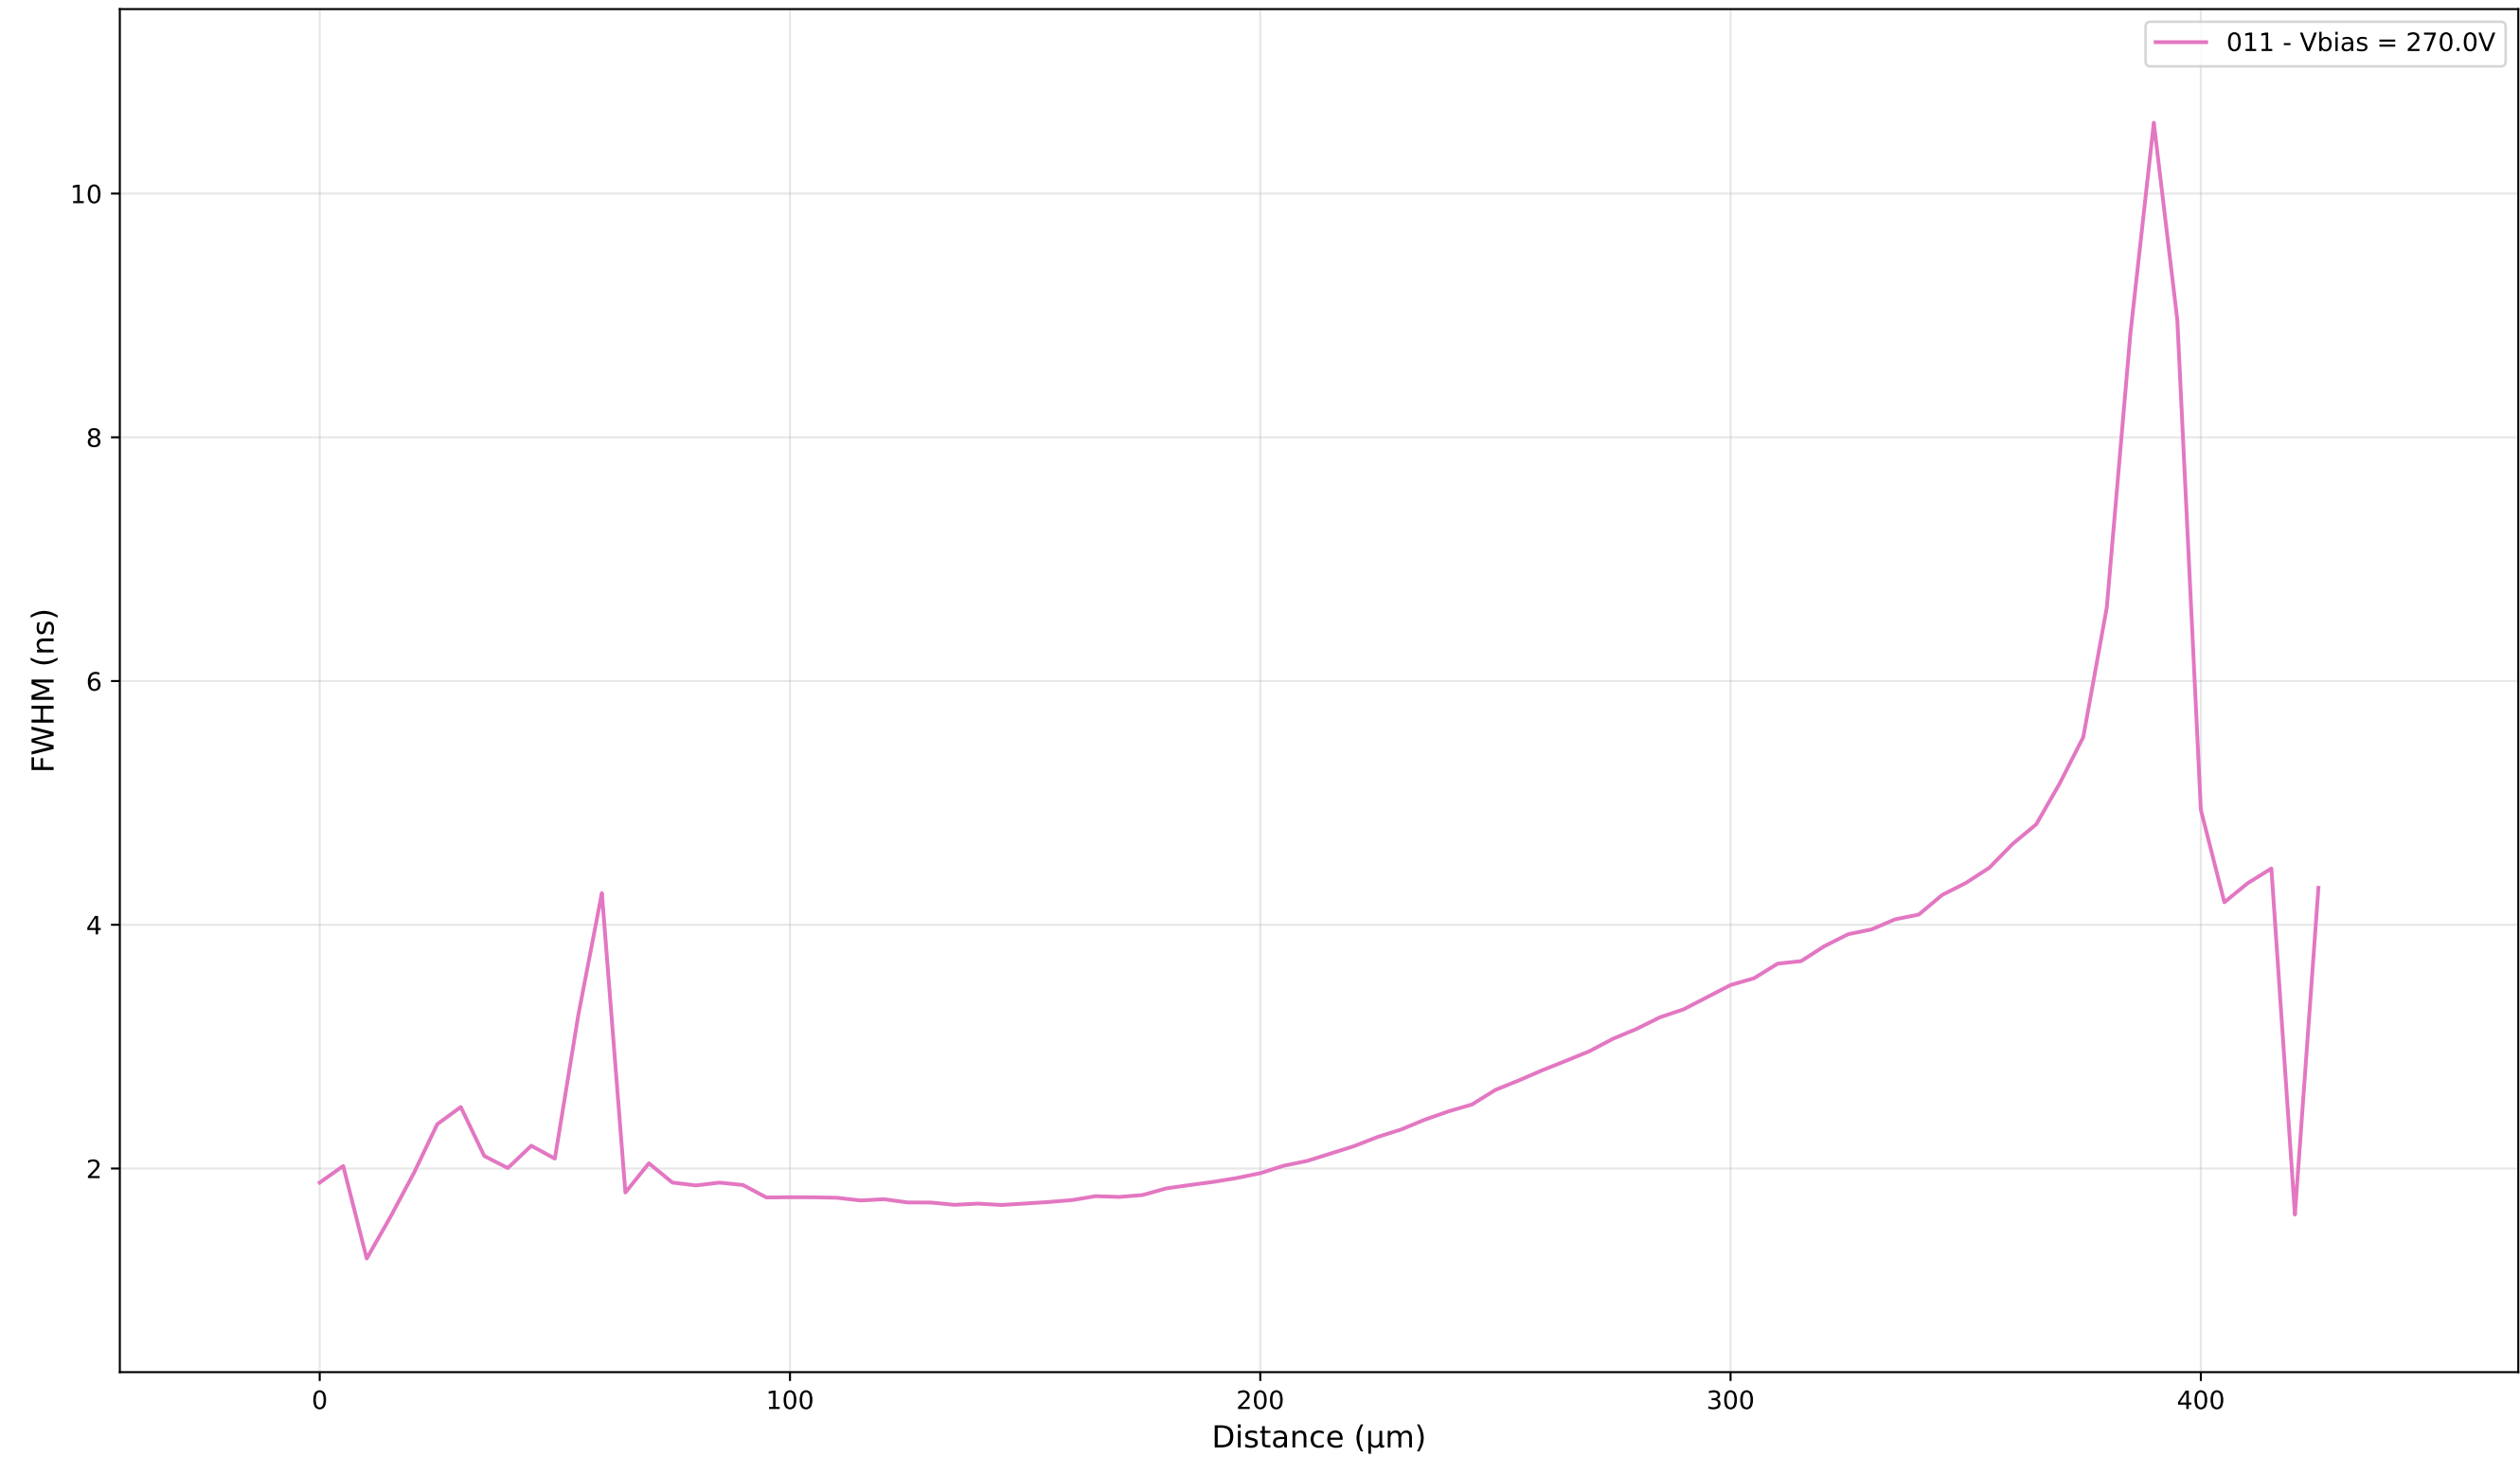


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.60 pC - Rise Time: 0.00 ns (N/A)

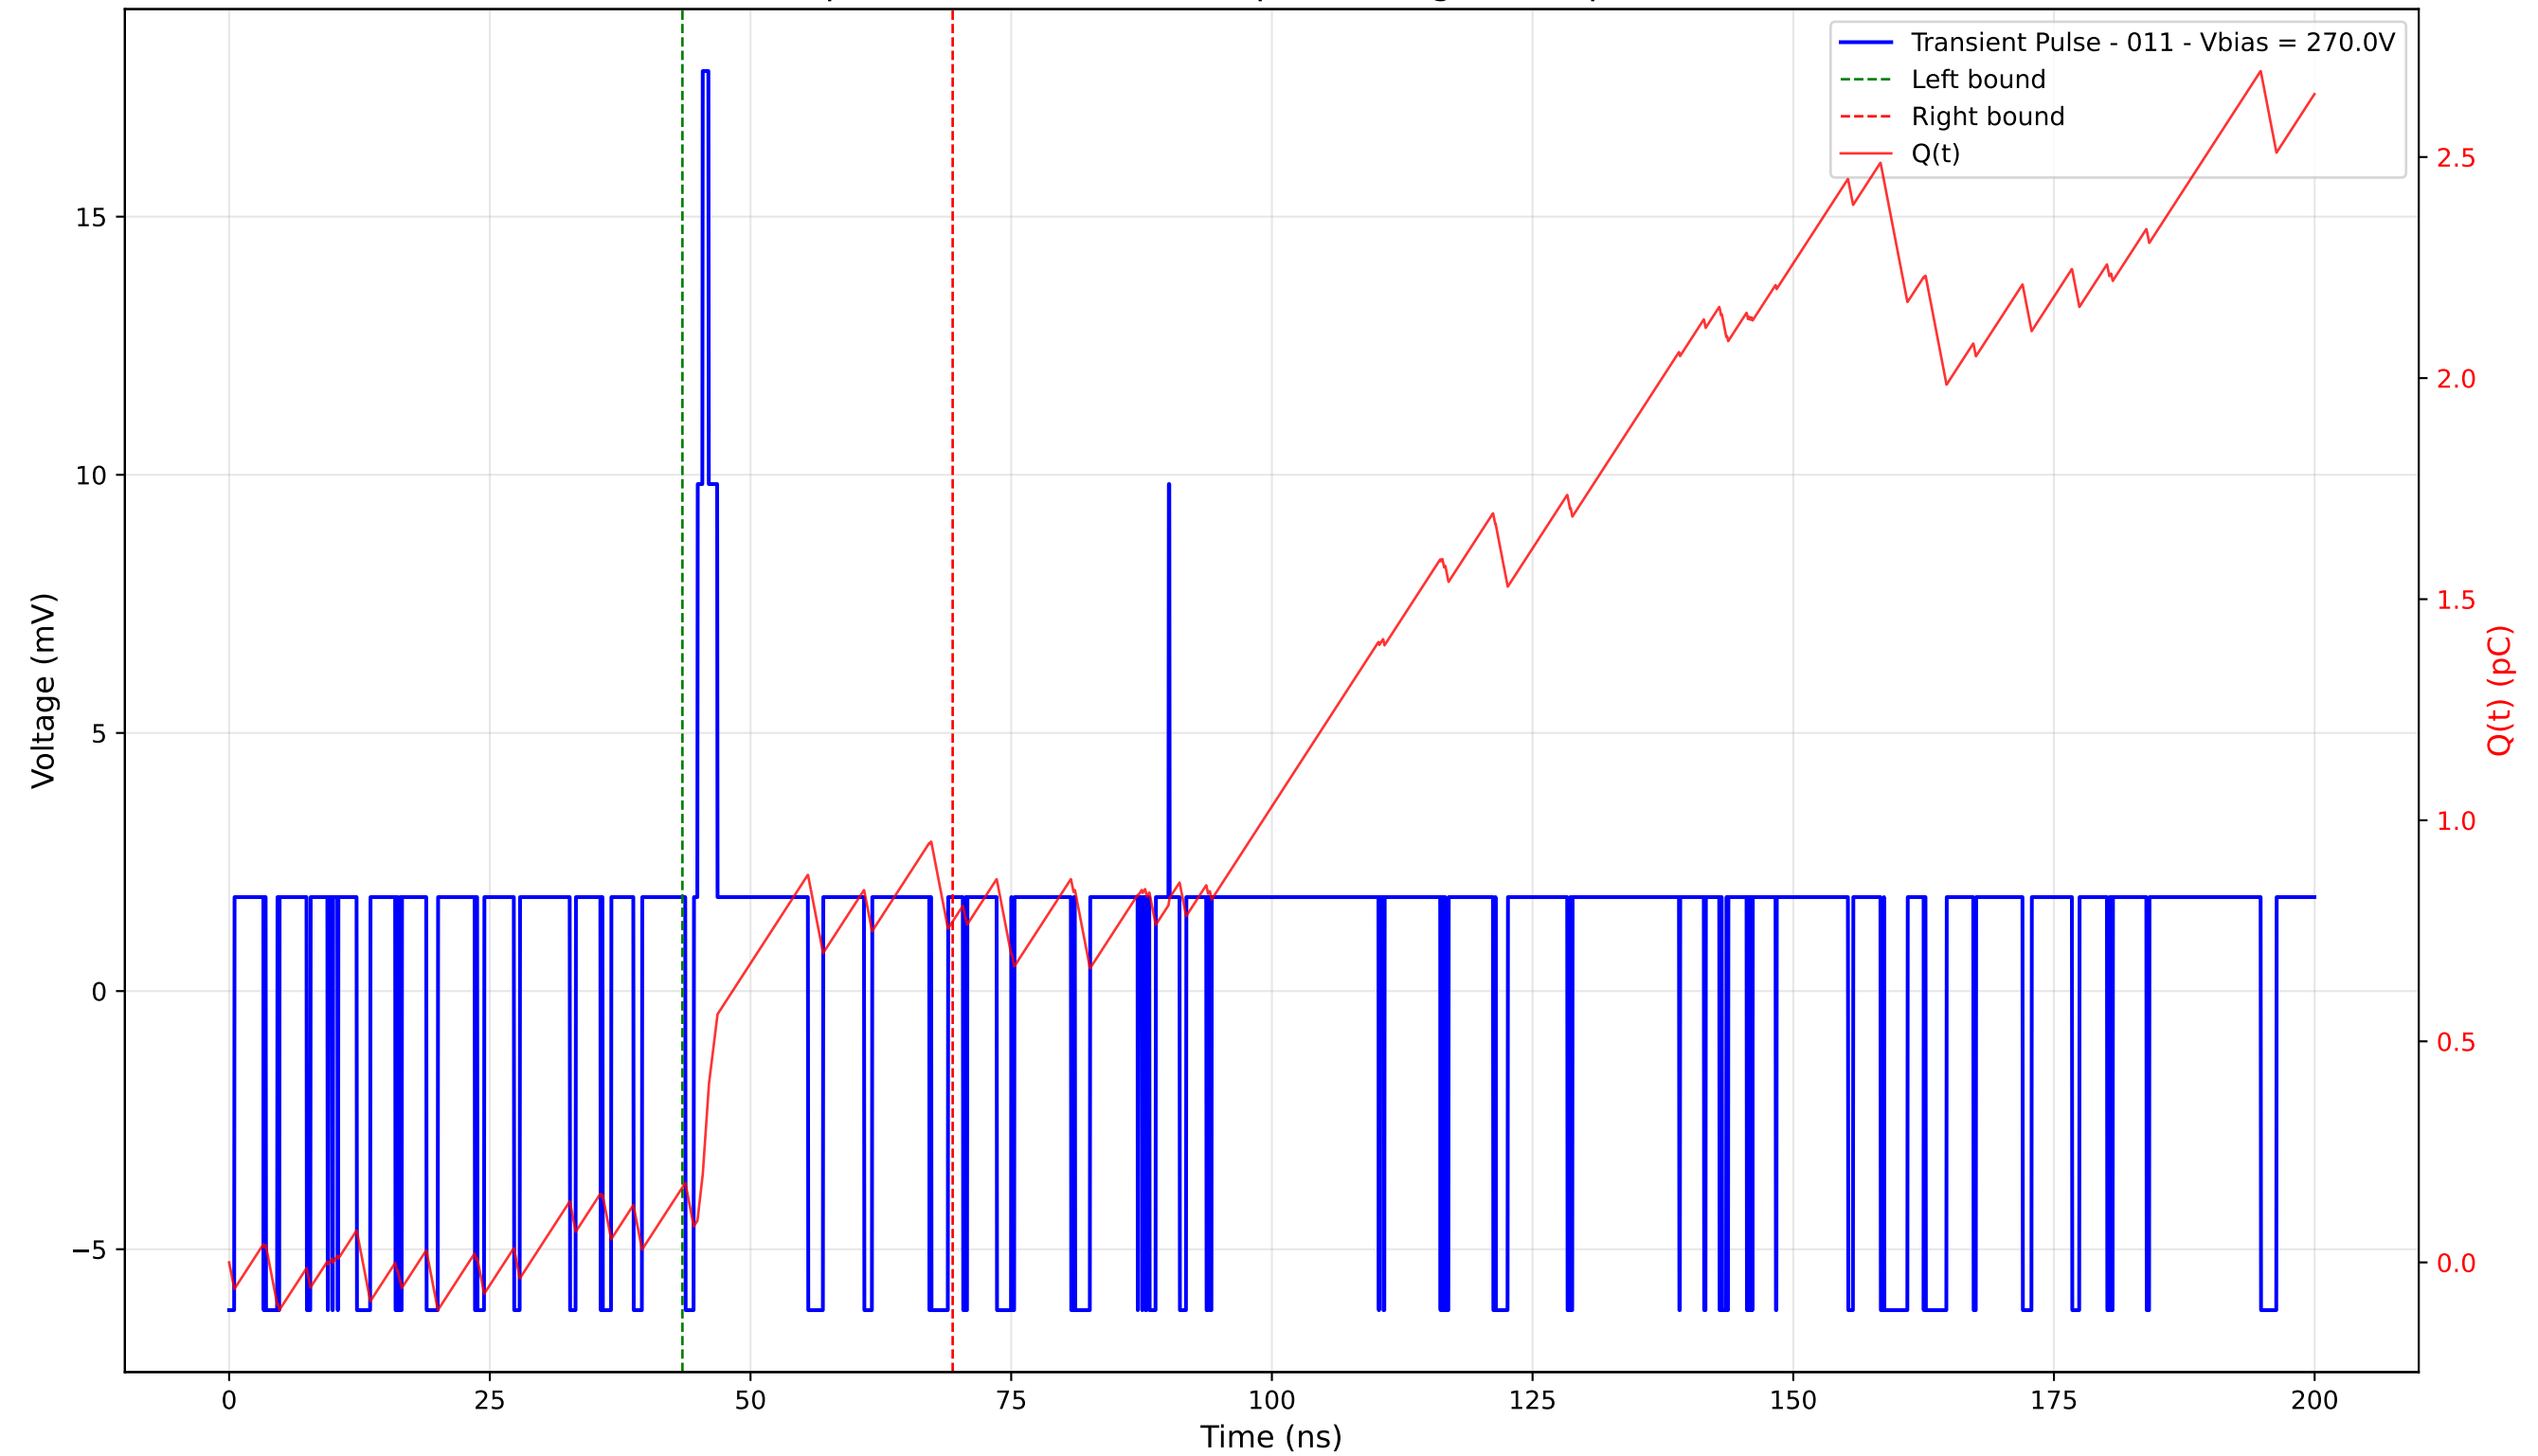


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.22 pC - Rise Time: 0.52 ns

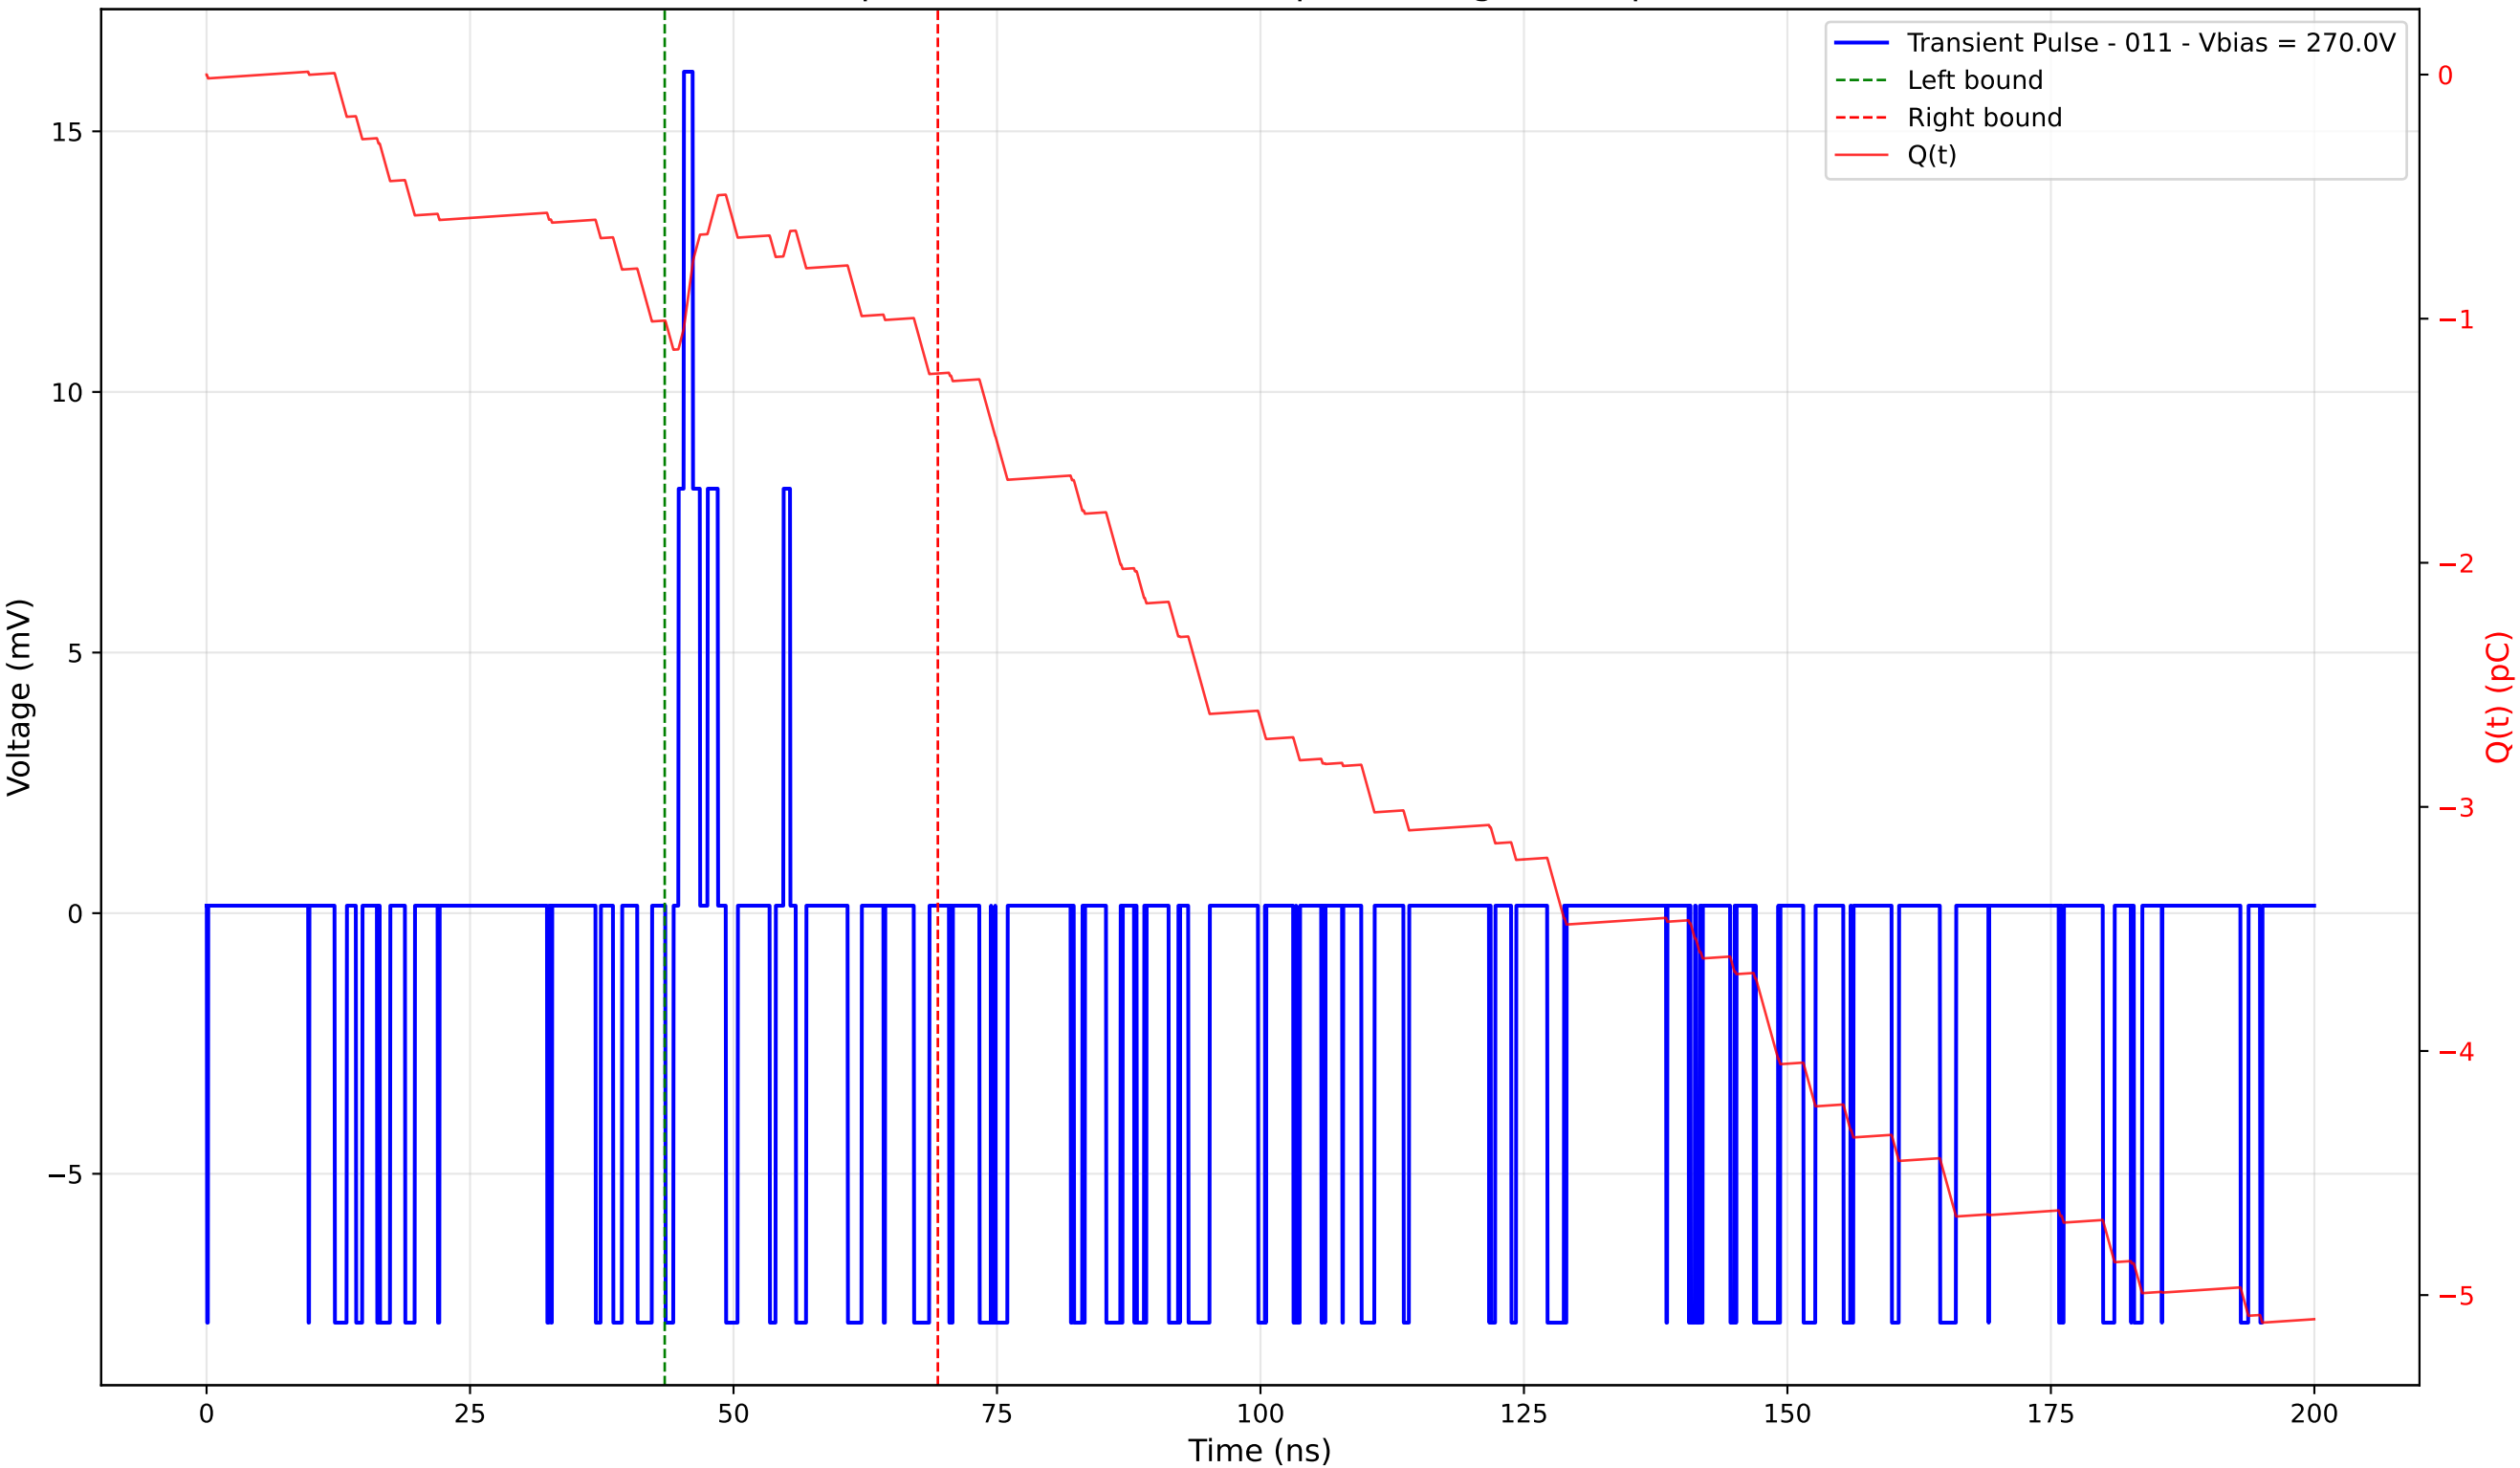


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.44 pC - Rise Time: 0.78 ns

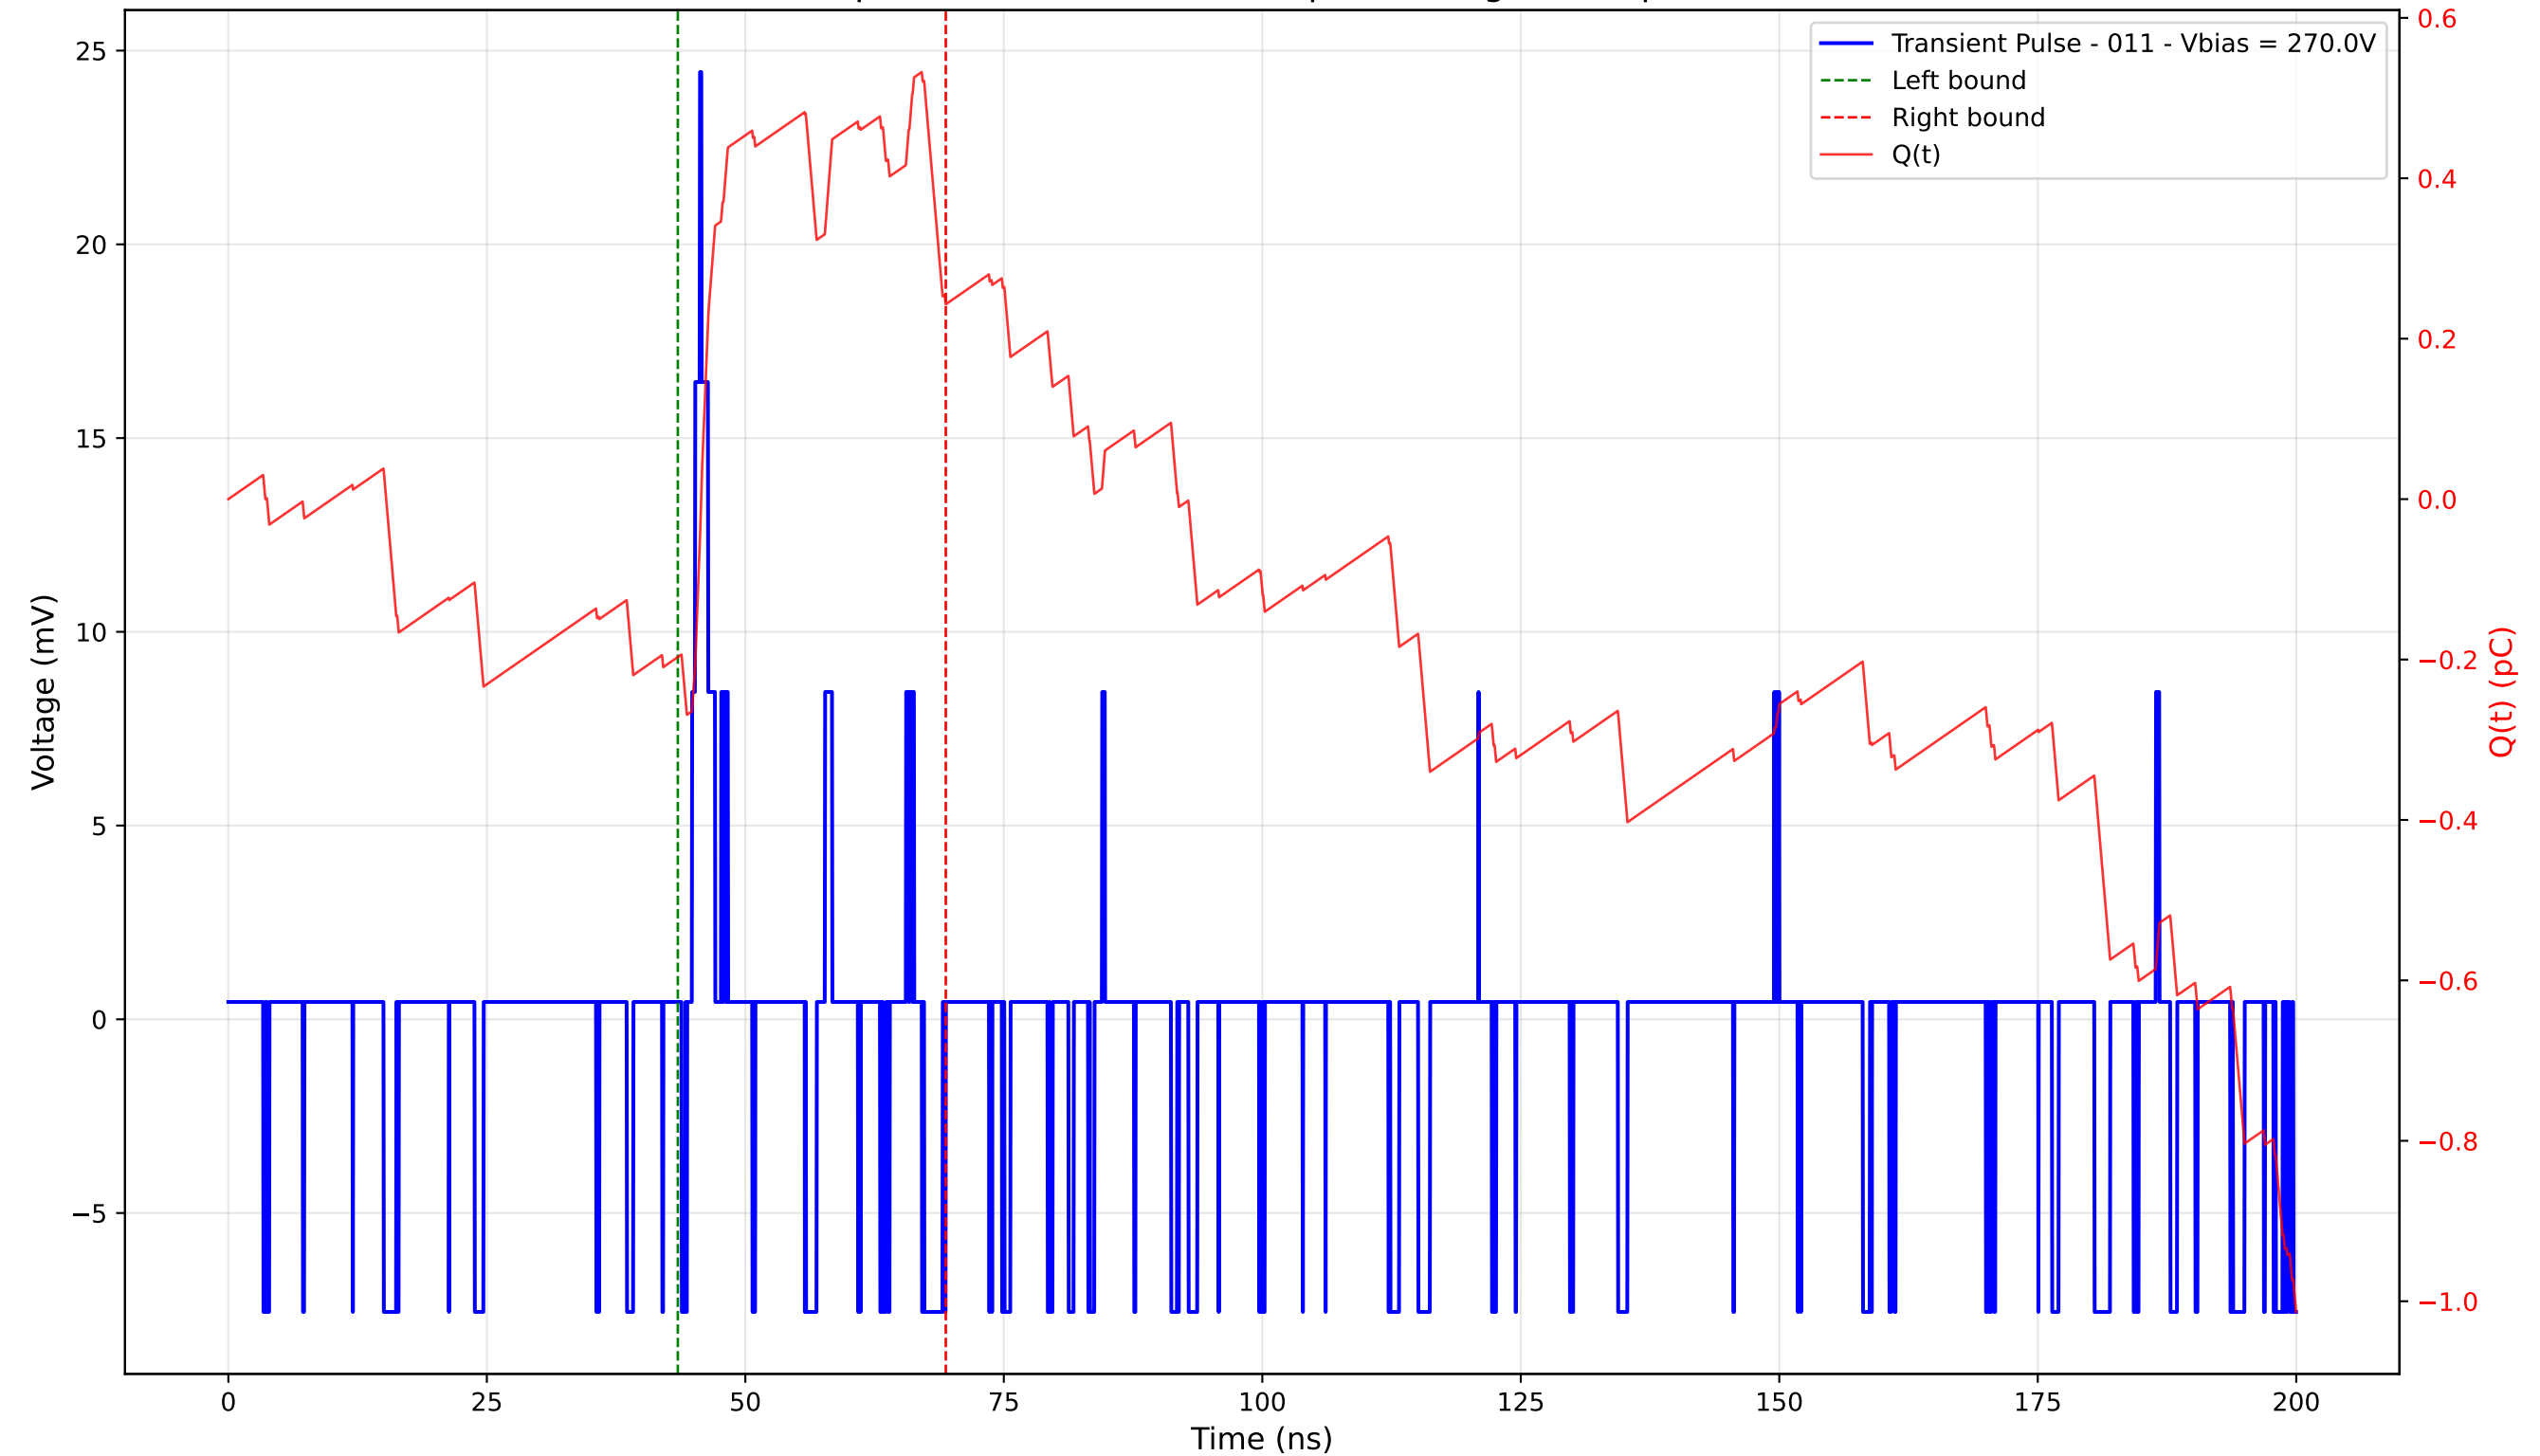


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 0.35 pC - Rise Time: 0.61 ns

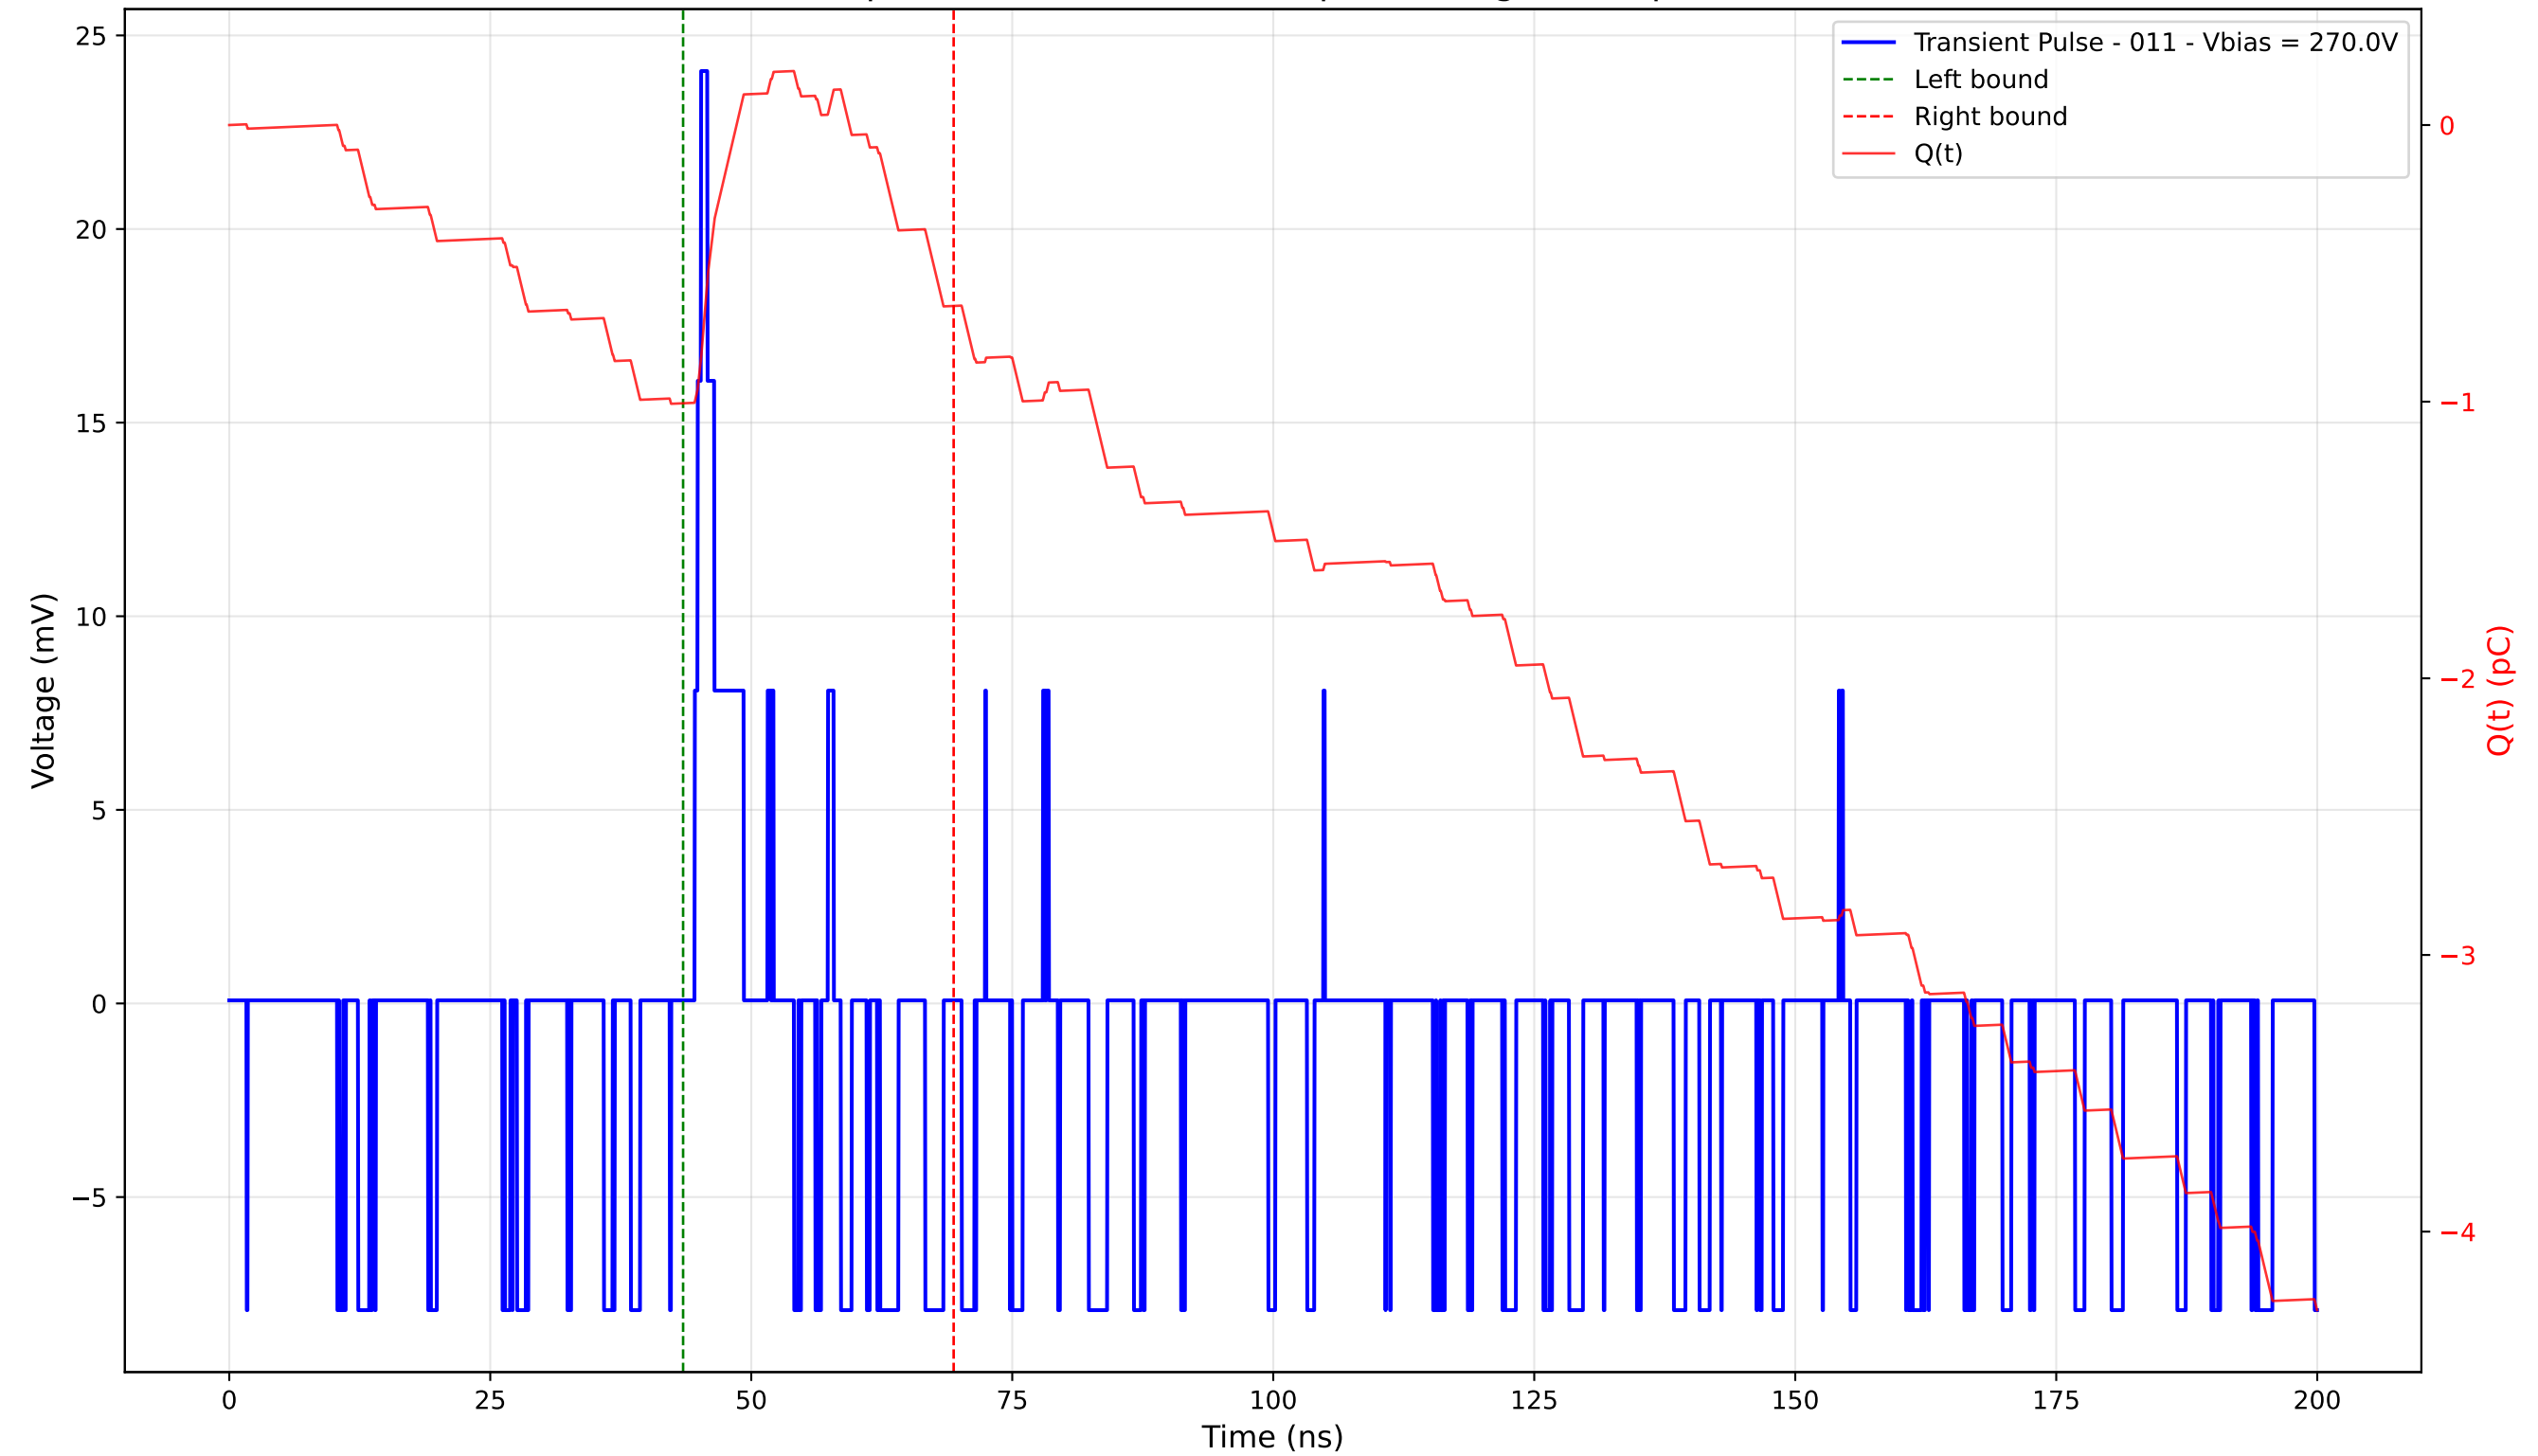


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 0.45 pC - Rise Time: 0.51 ns

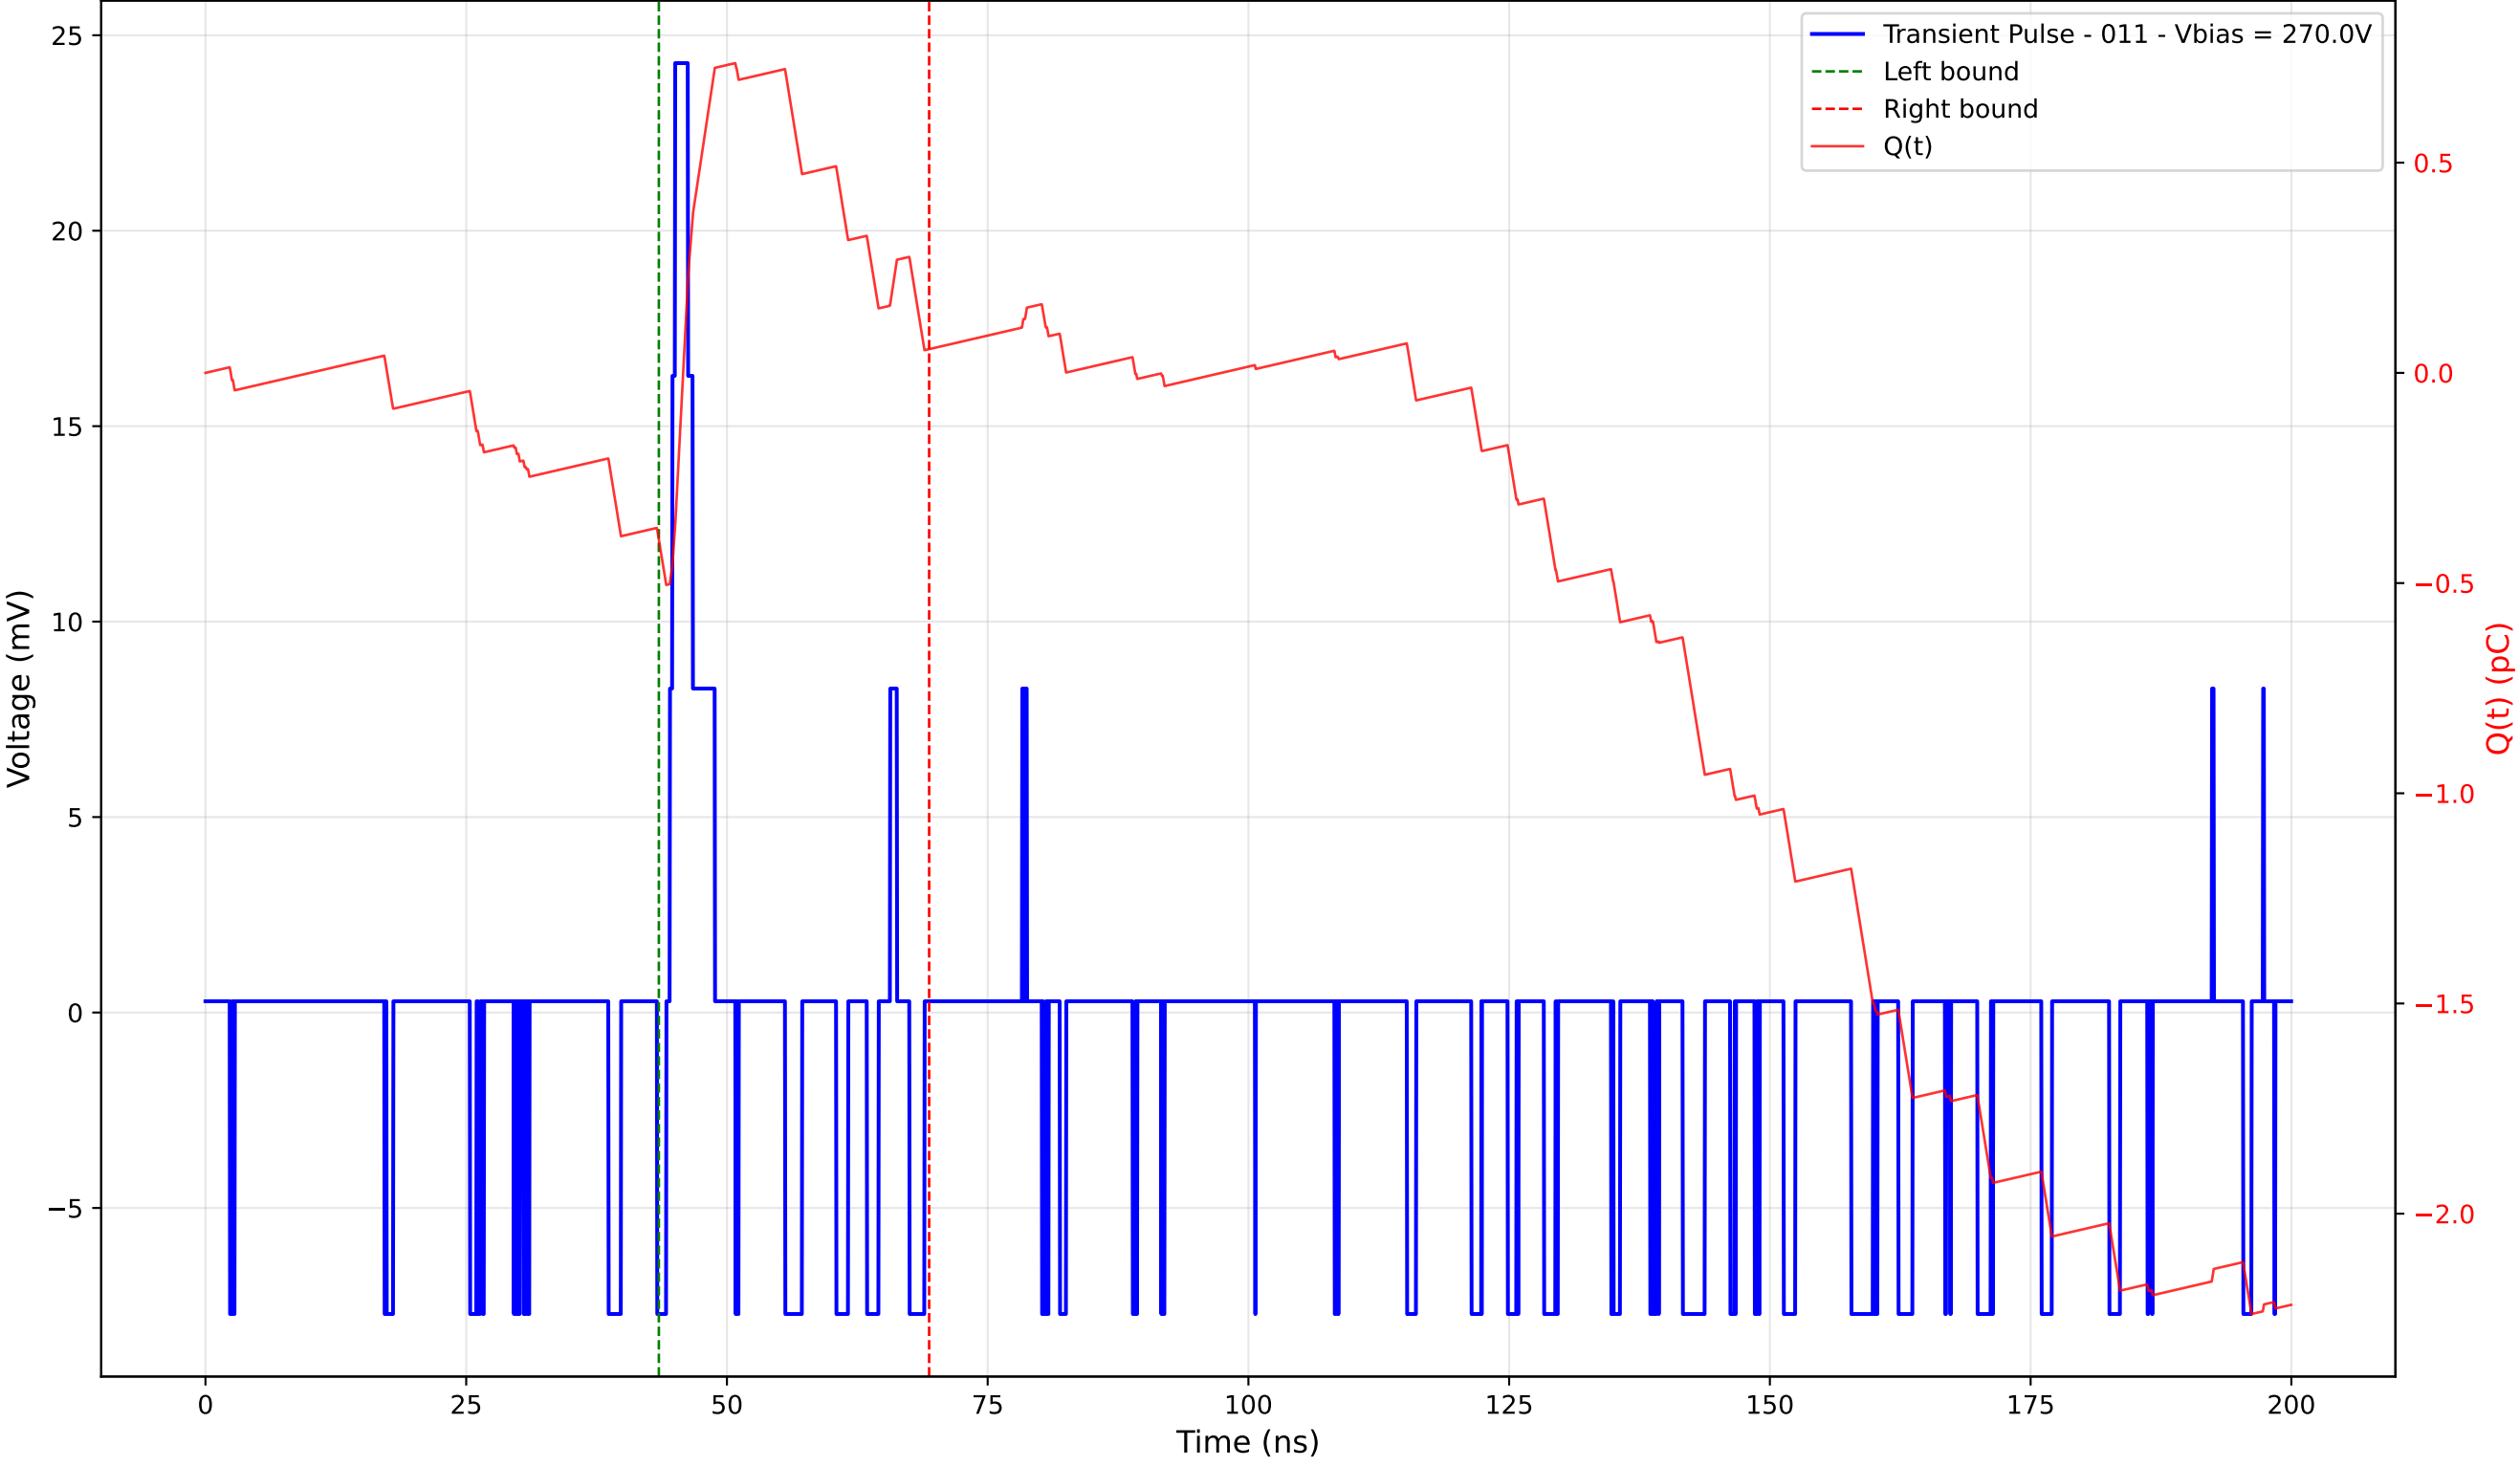


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.66 pC - Rise Time: 0.76 ns

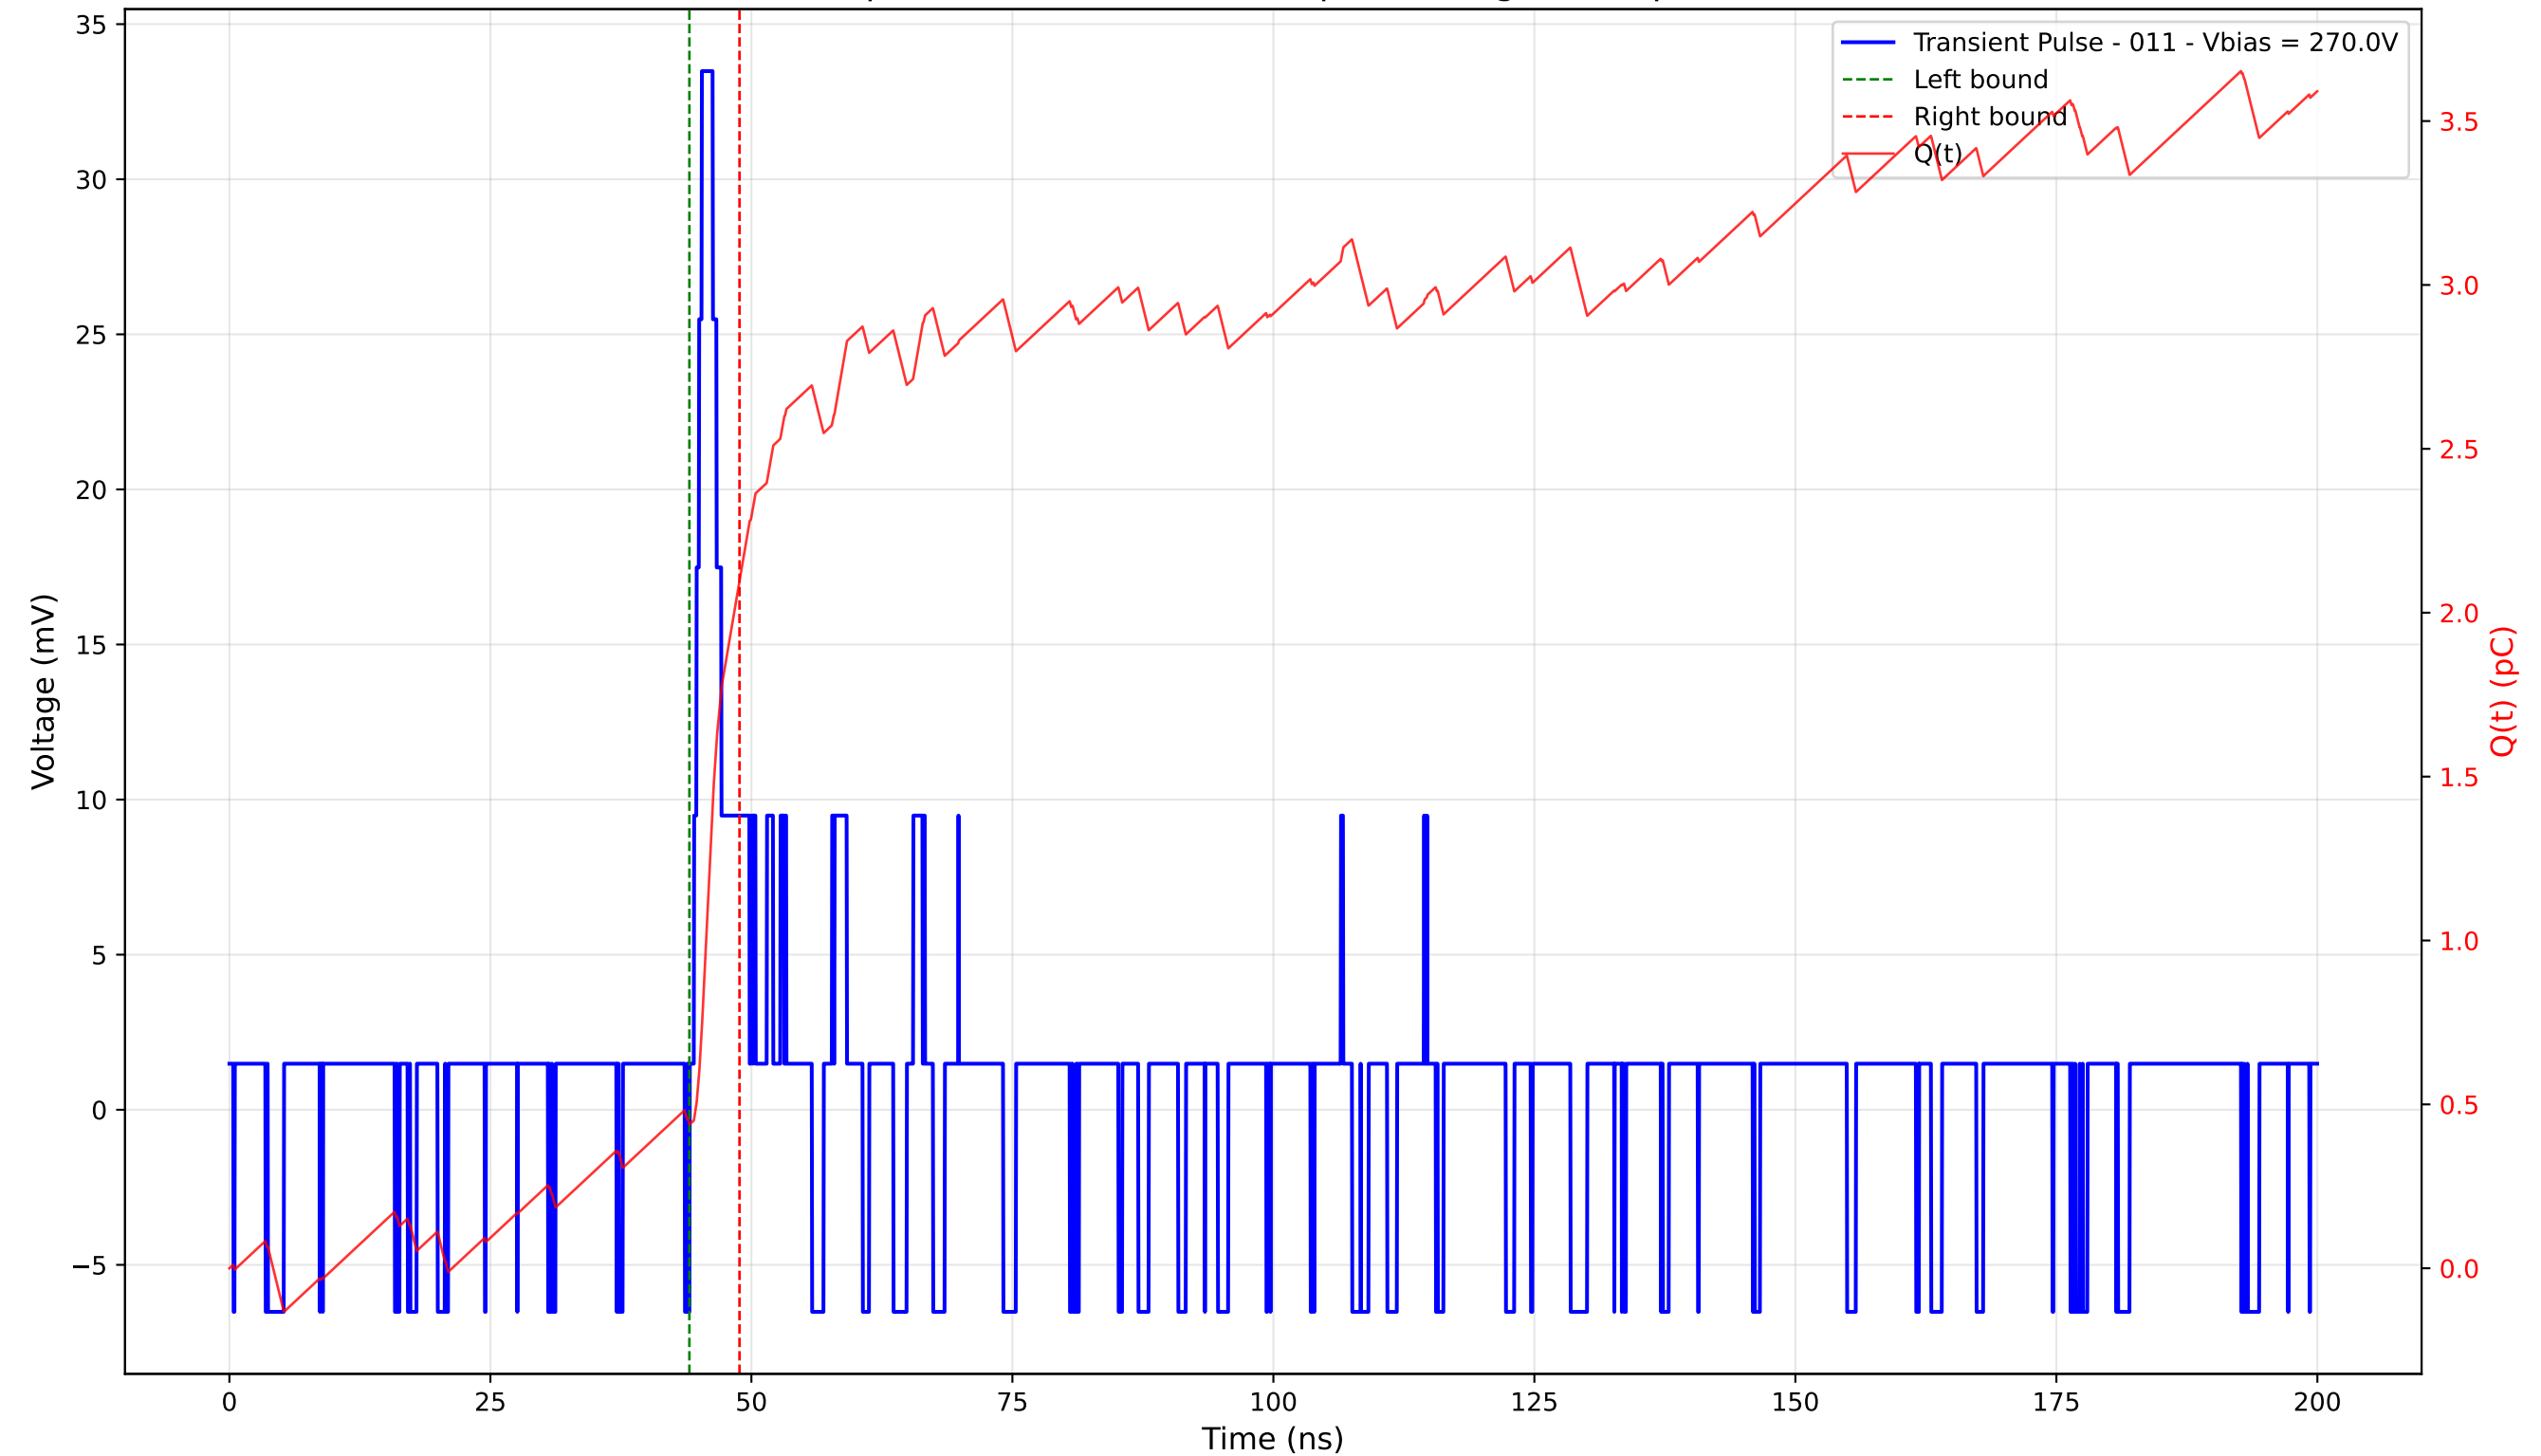


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.60 pC - Rise Time: 0.70 ns

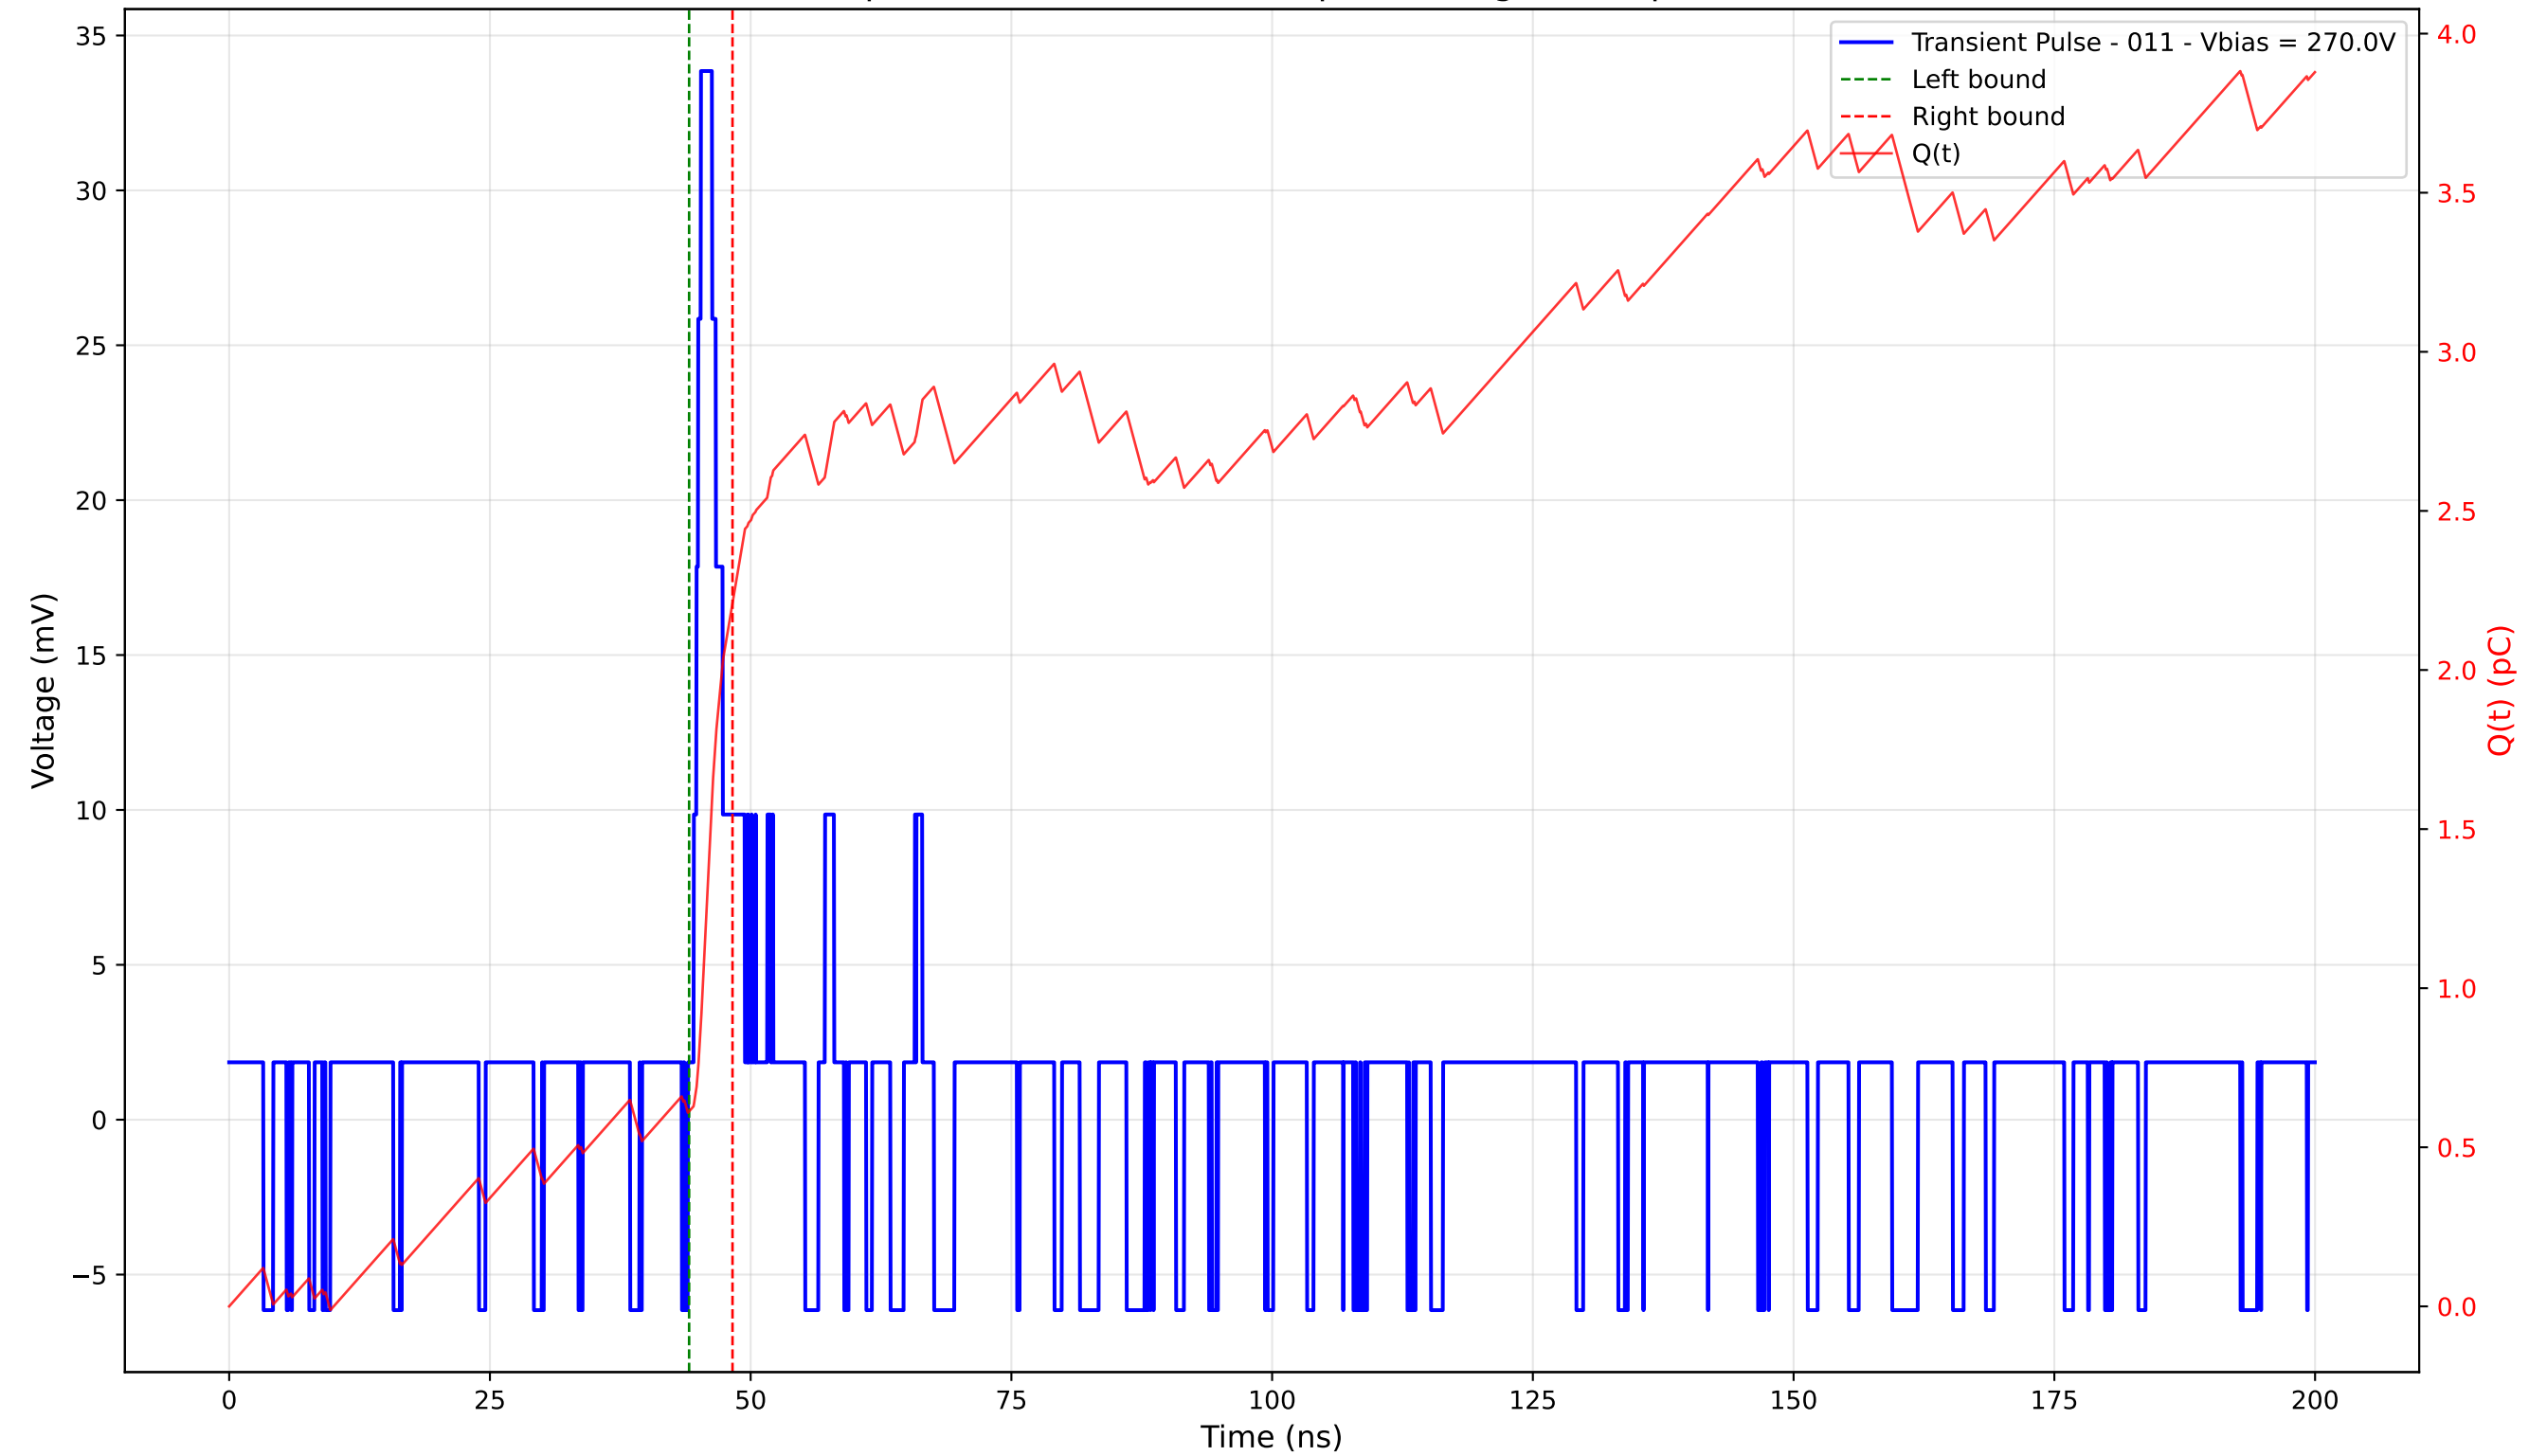


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.66 pC - Rise Time: 0.69 ns

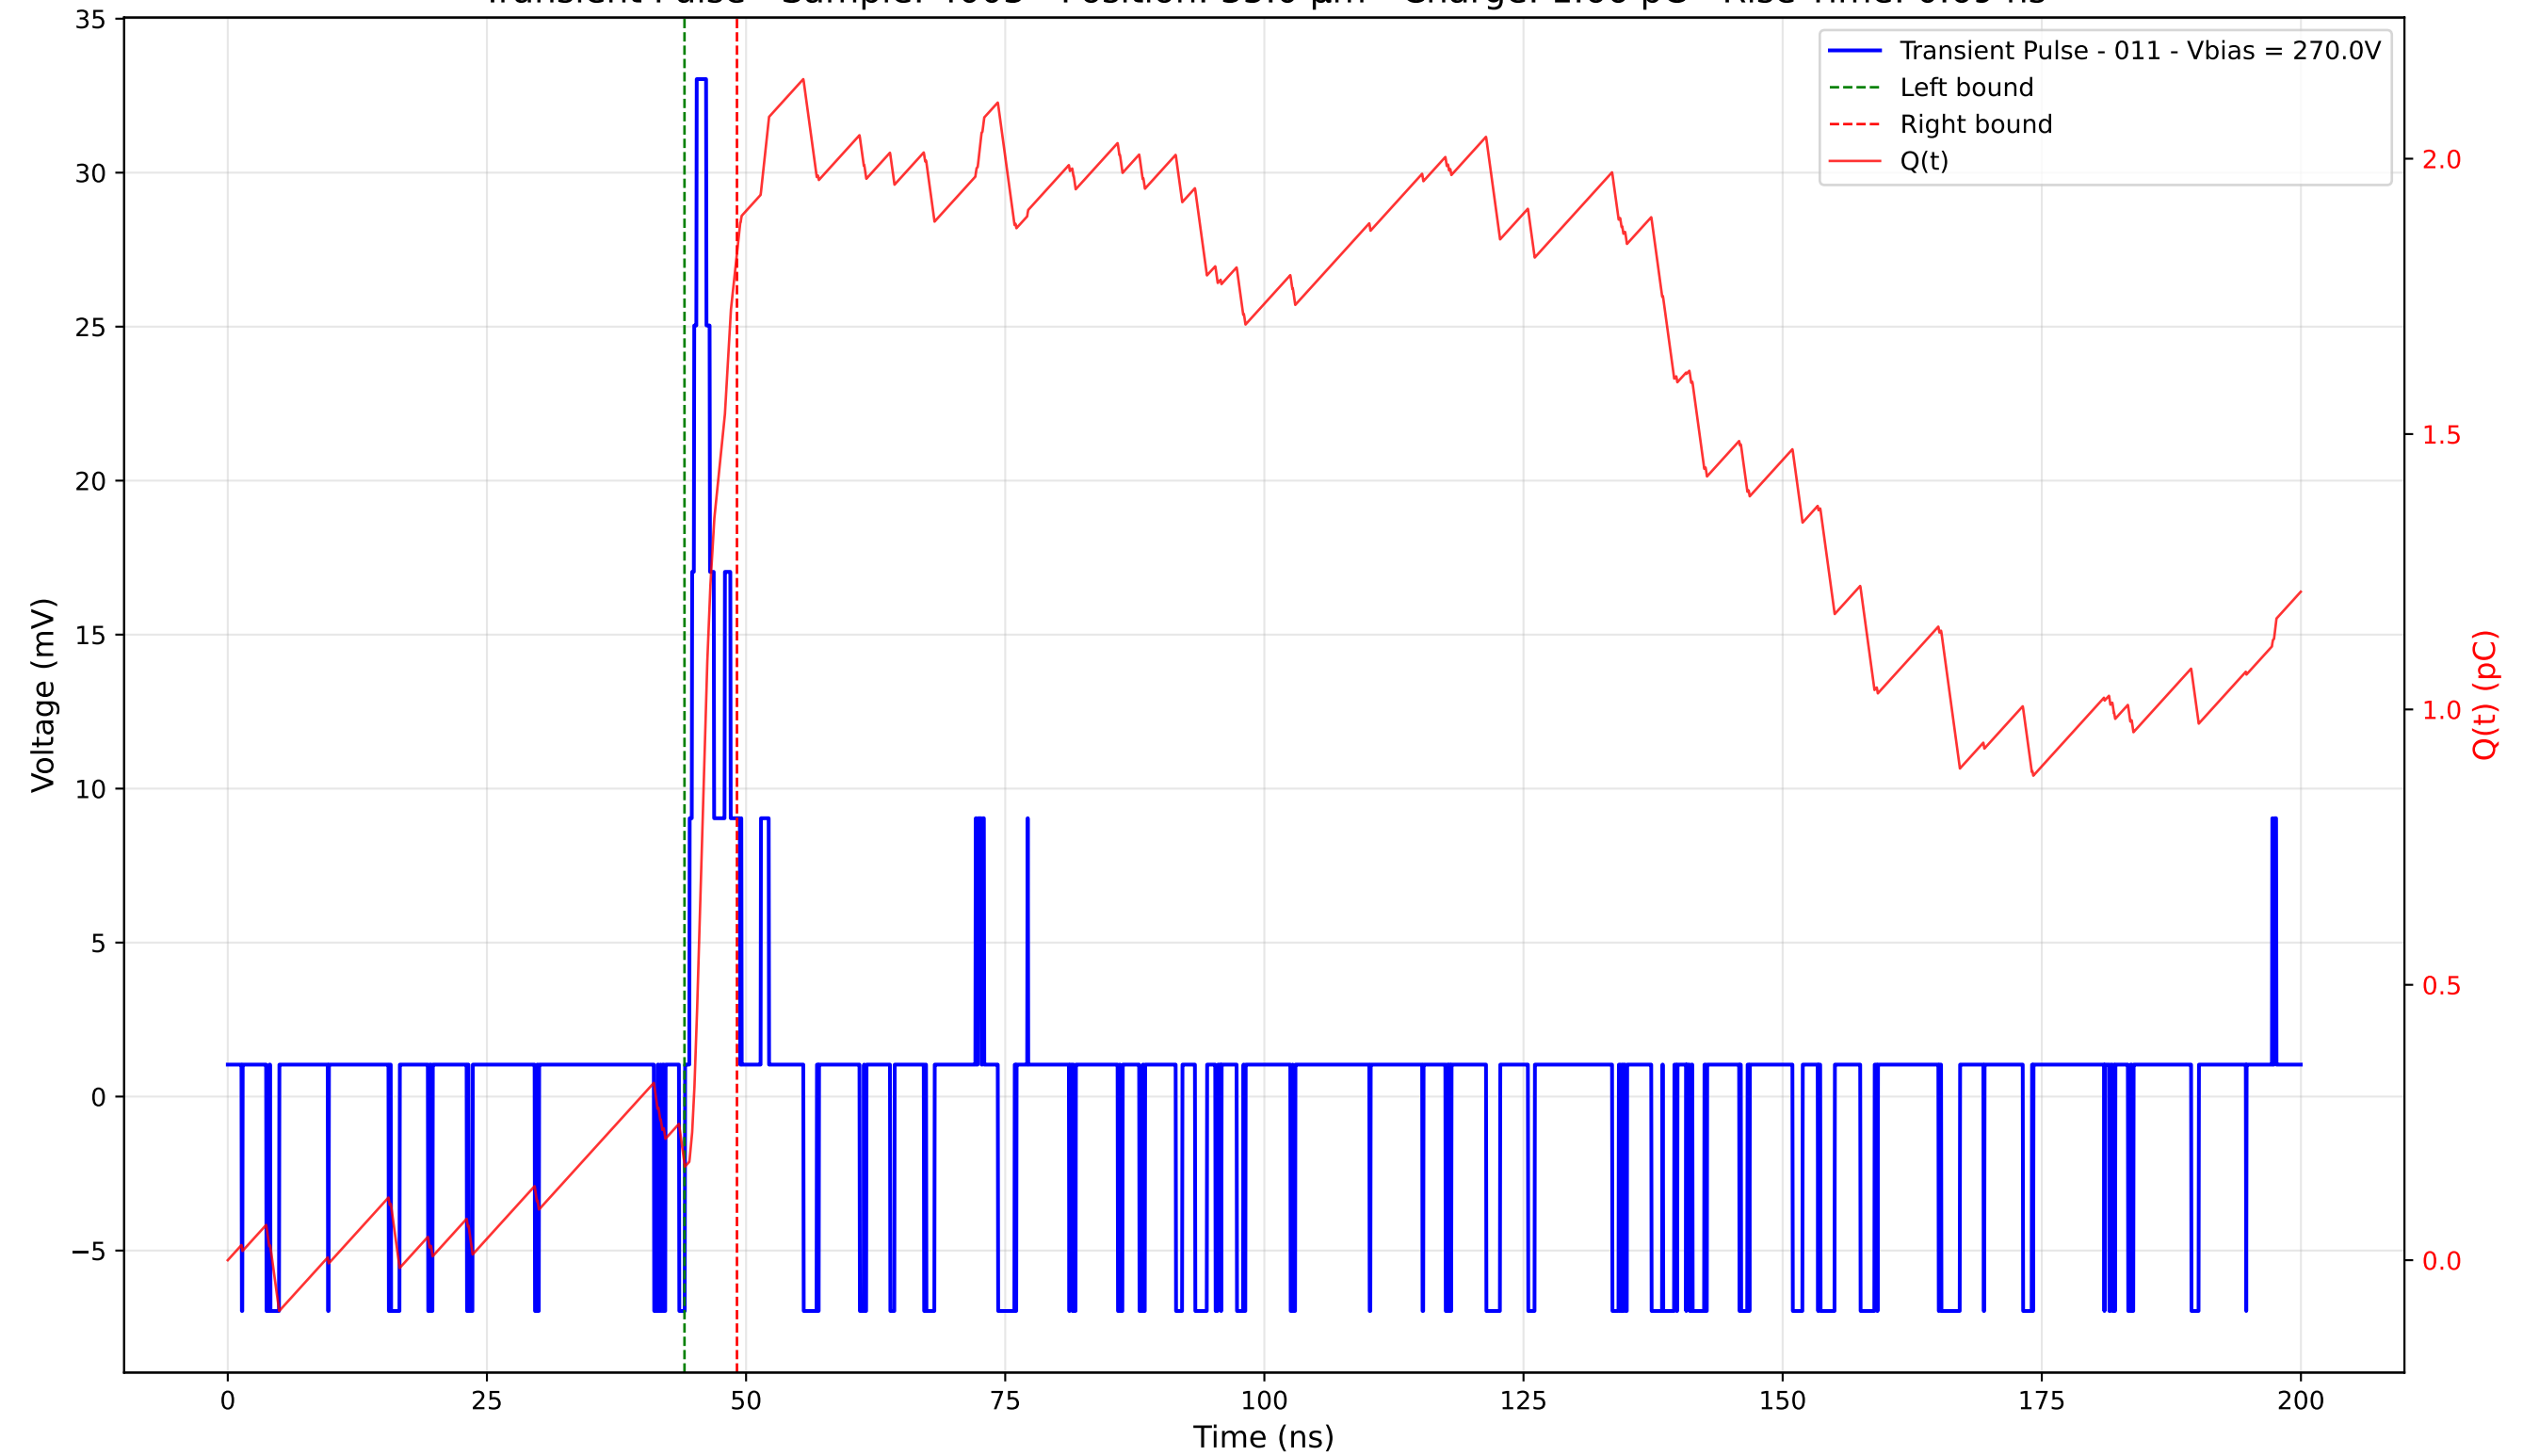


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.91 pC - Rise Time: 0.99 ns

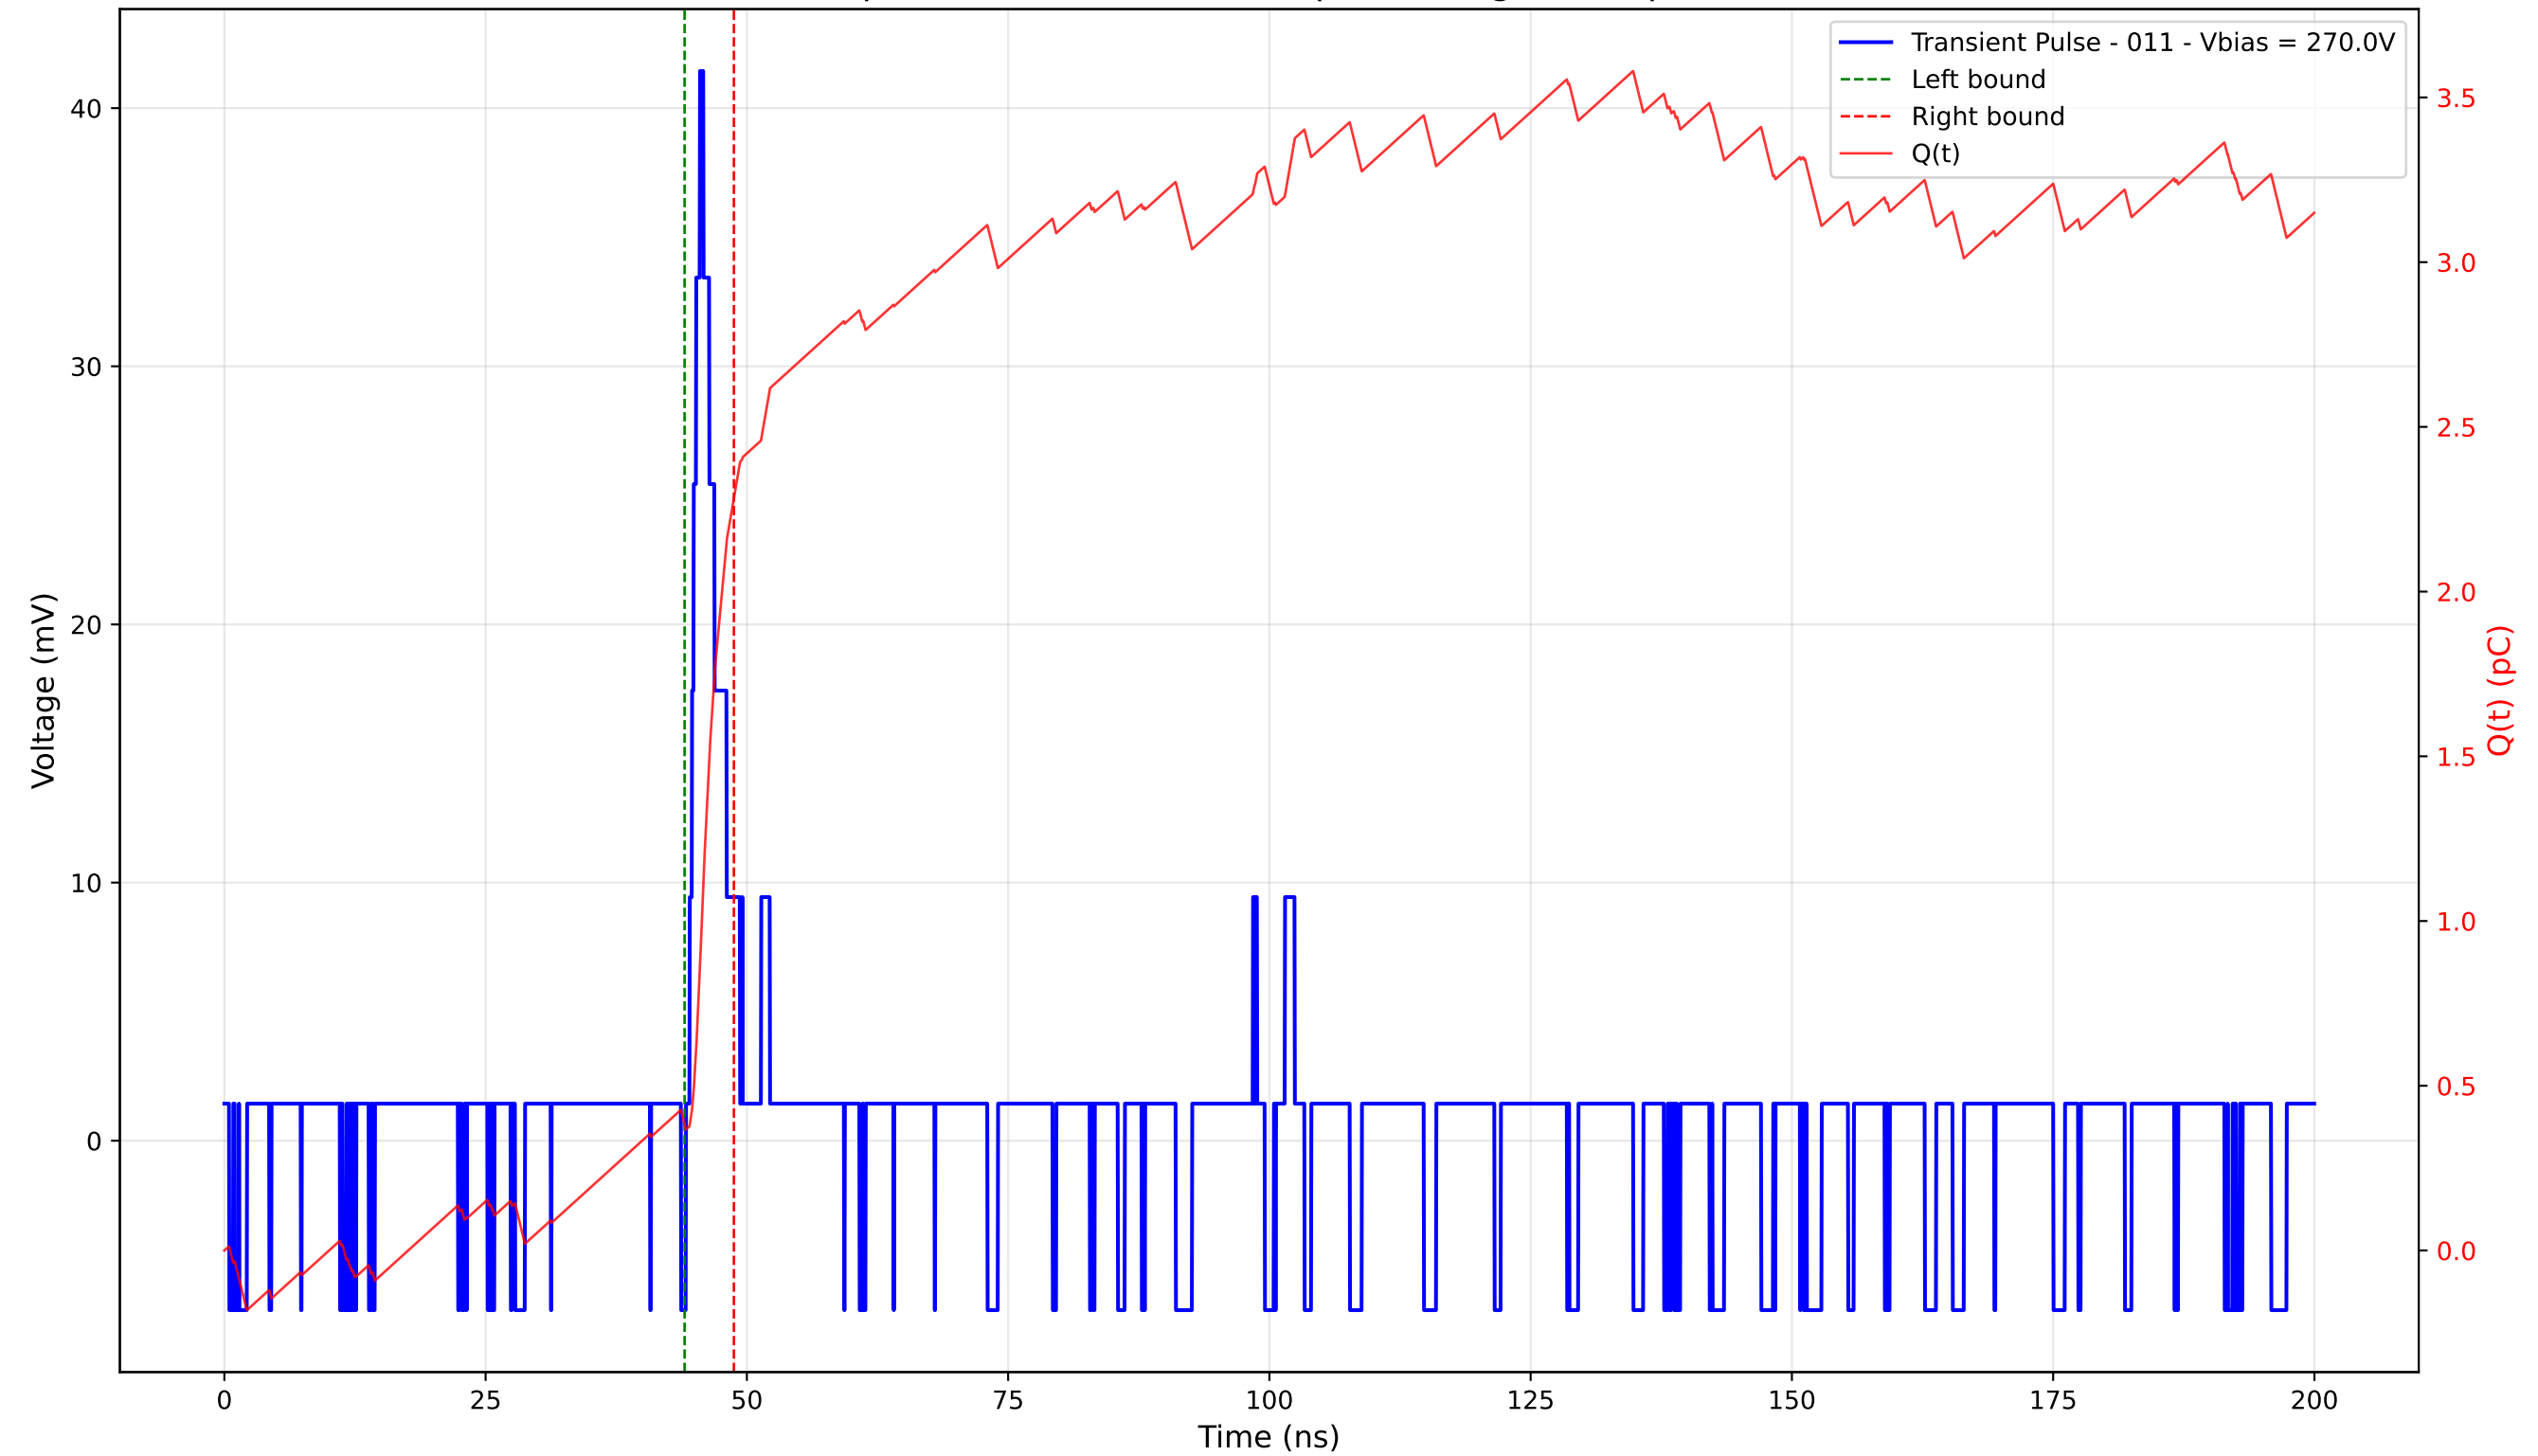


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.48 pC - Rise Time: 0.85 ns

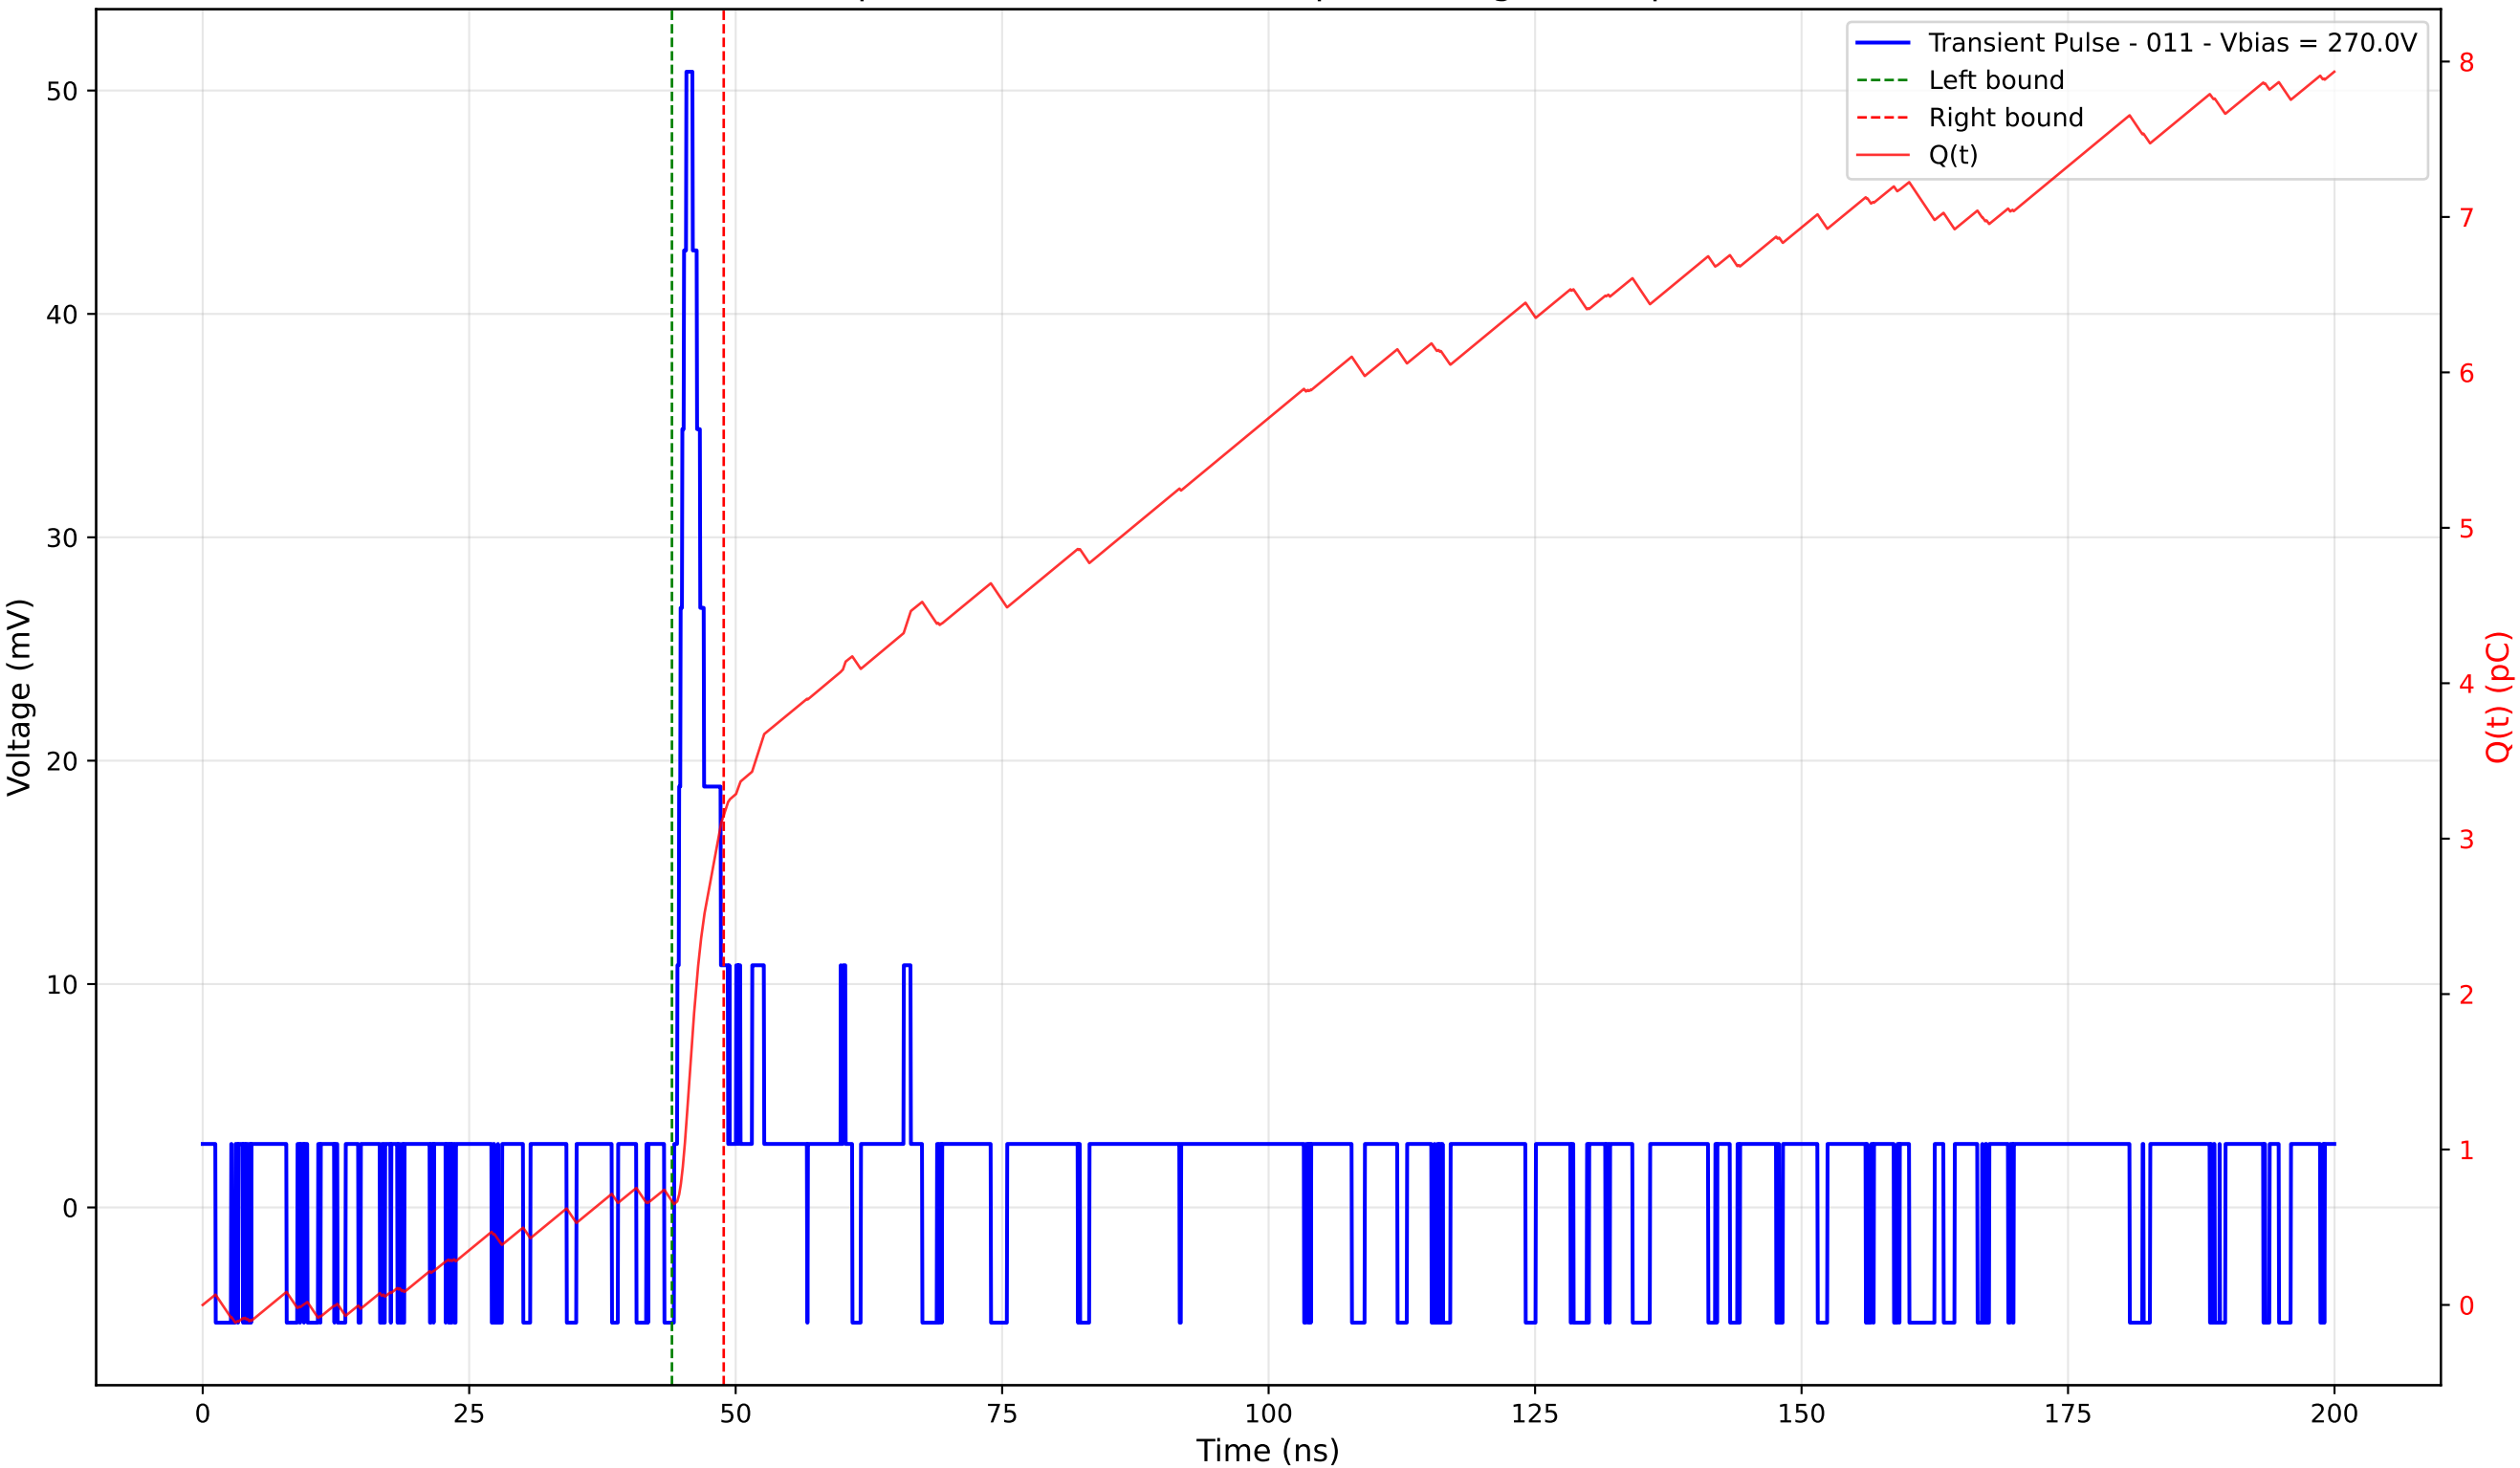


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 2.93 pC - Rise Time: 1.05 ns

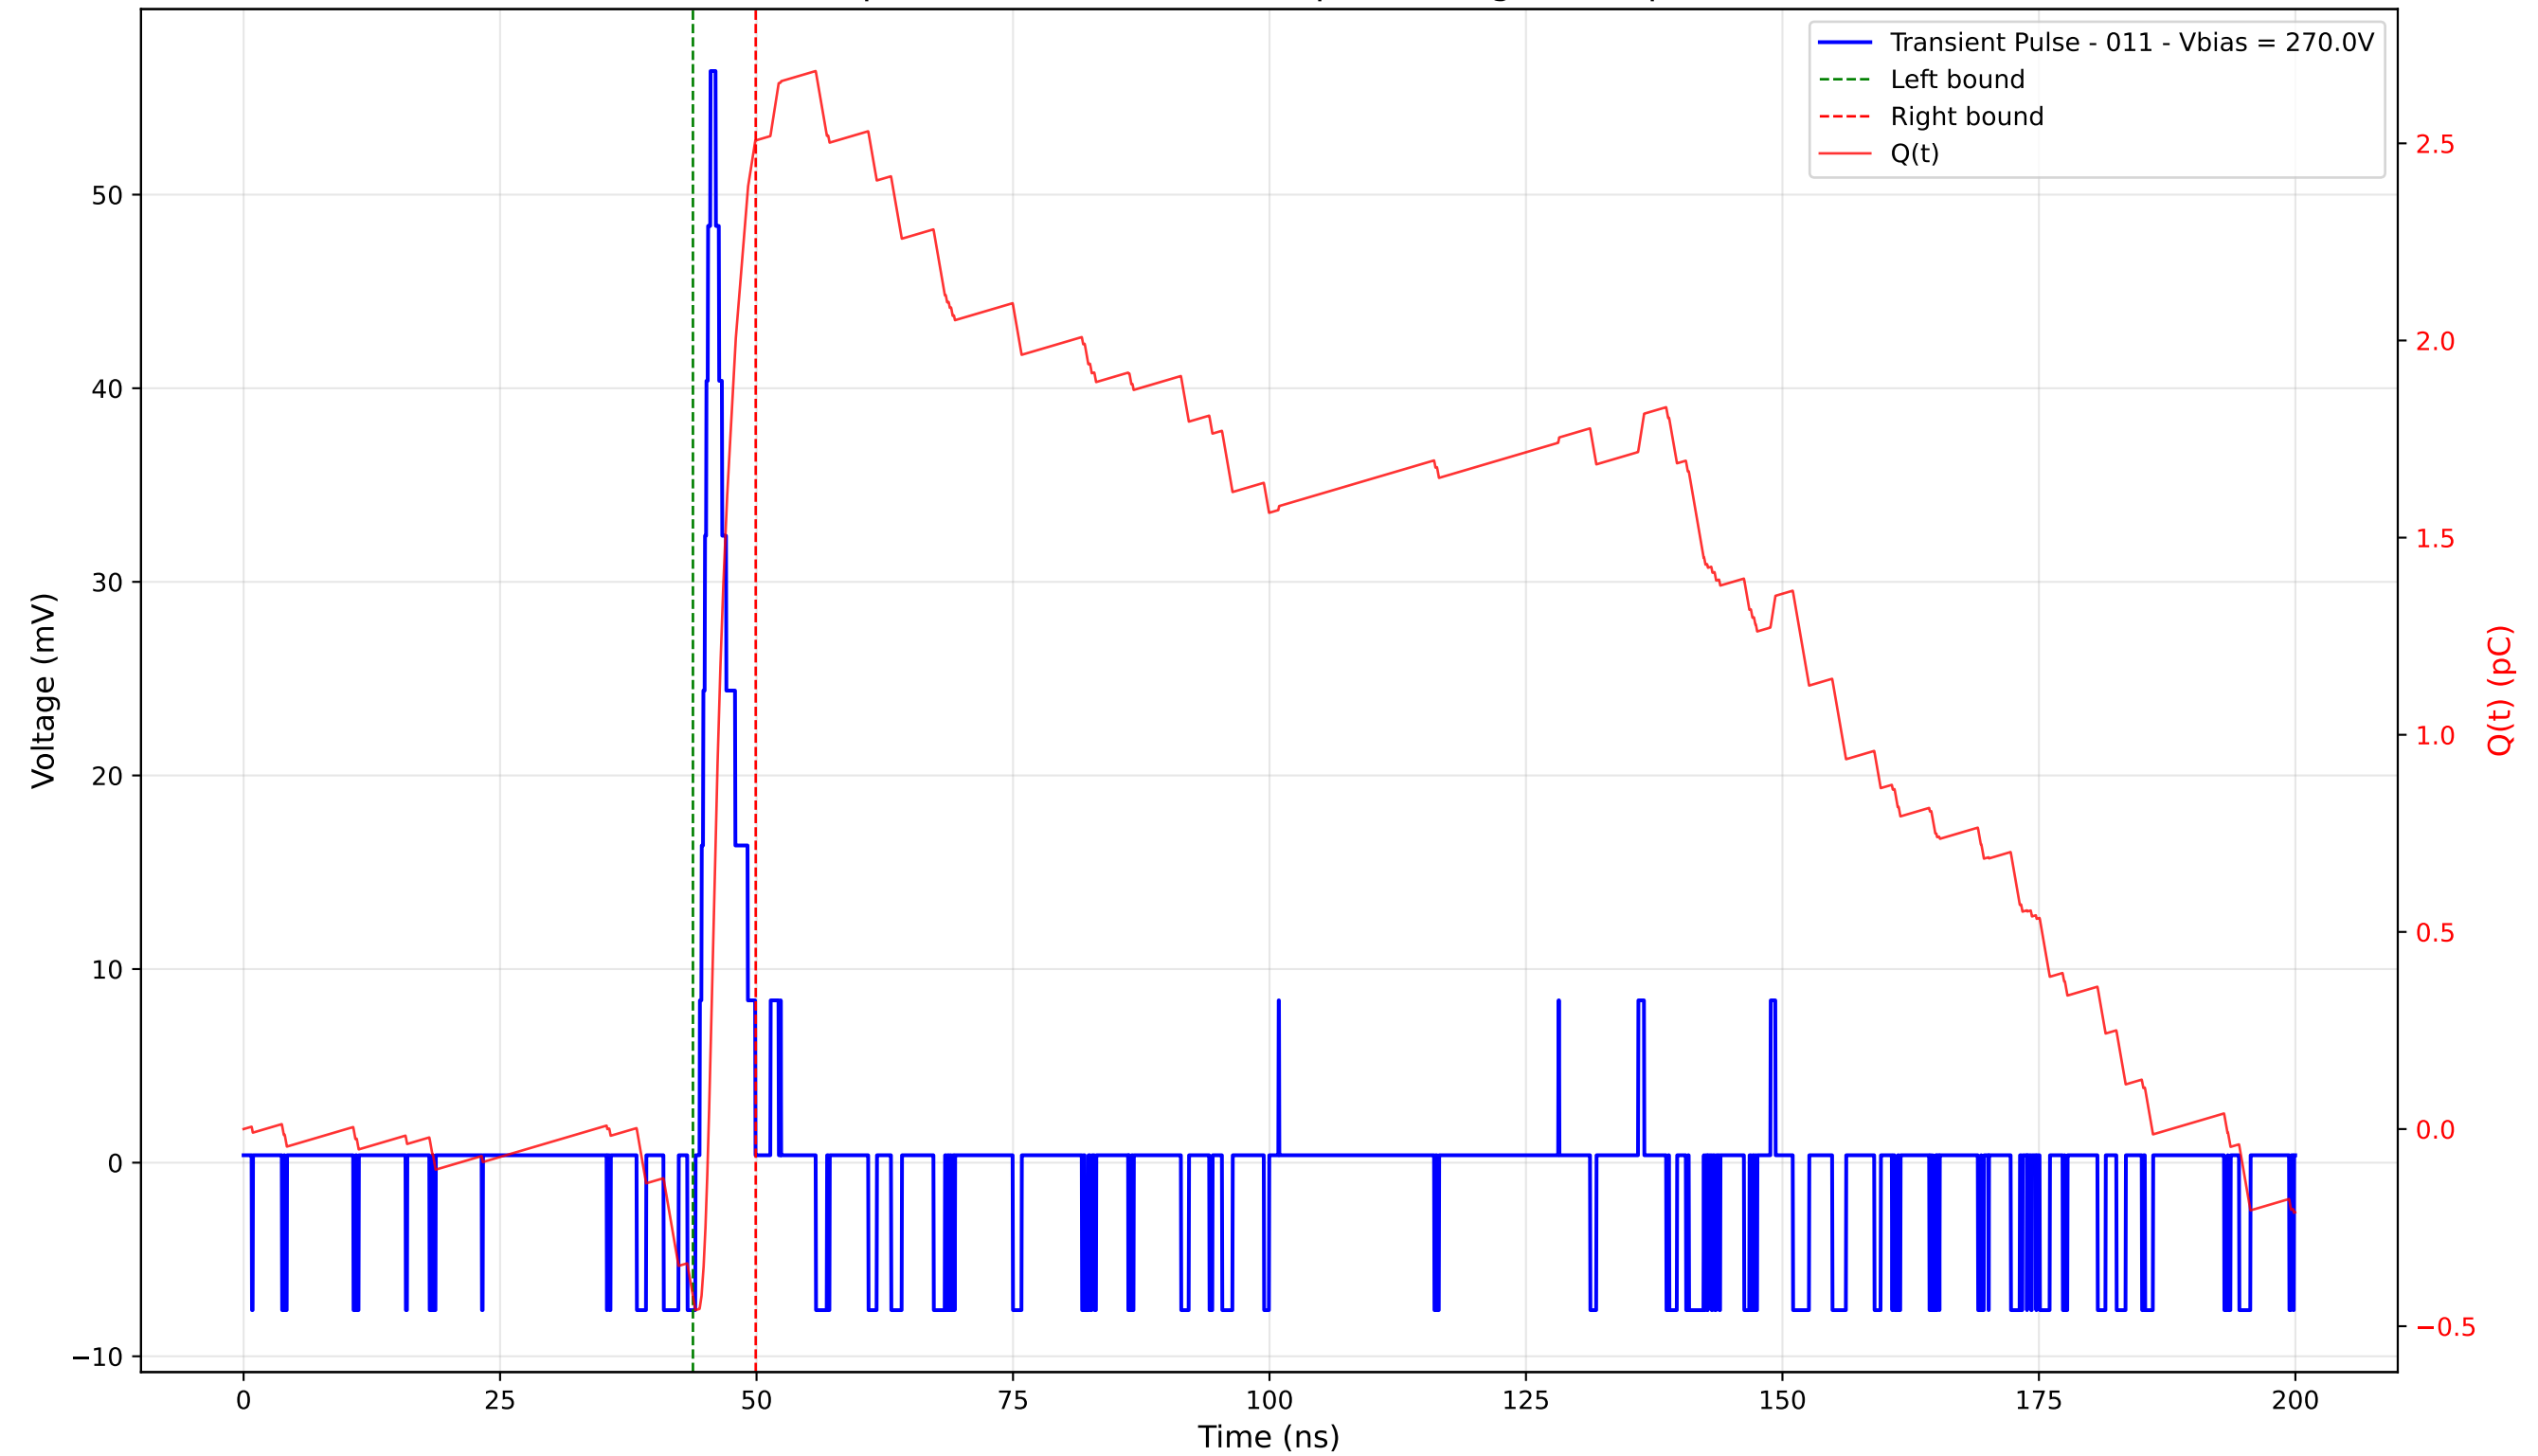


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.28 pC - Rise Time: 1.07 ns

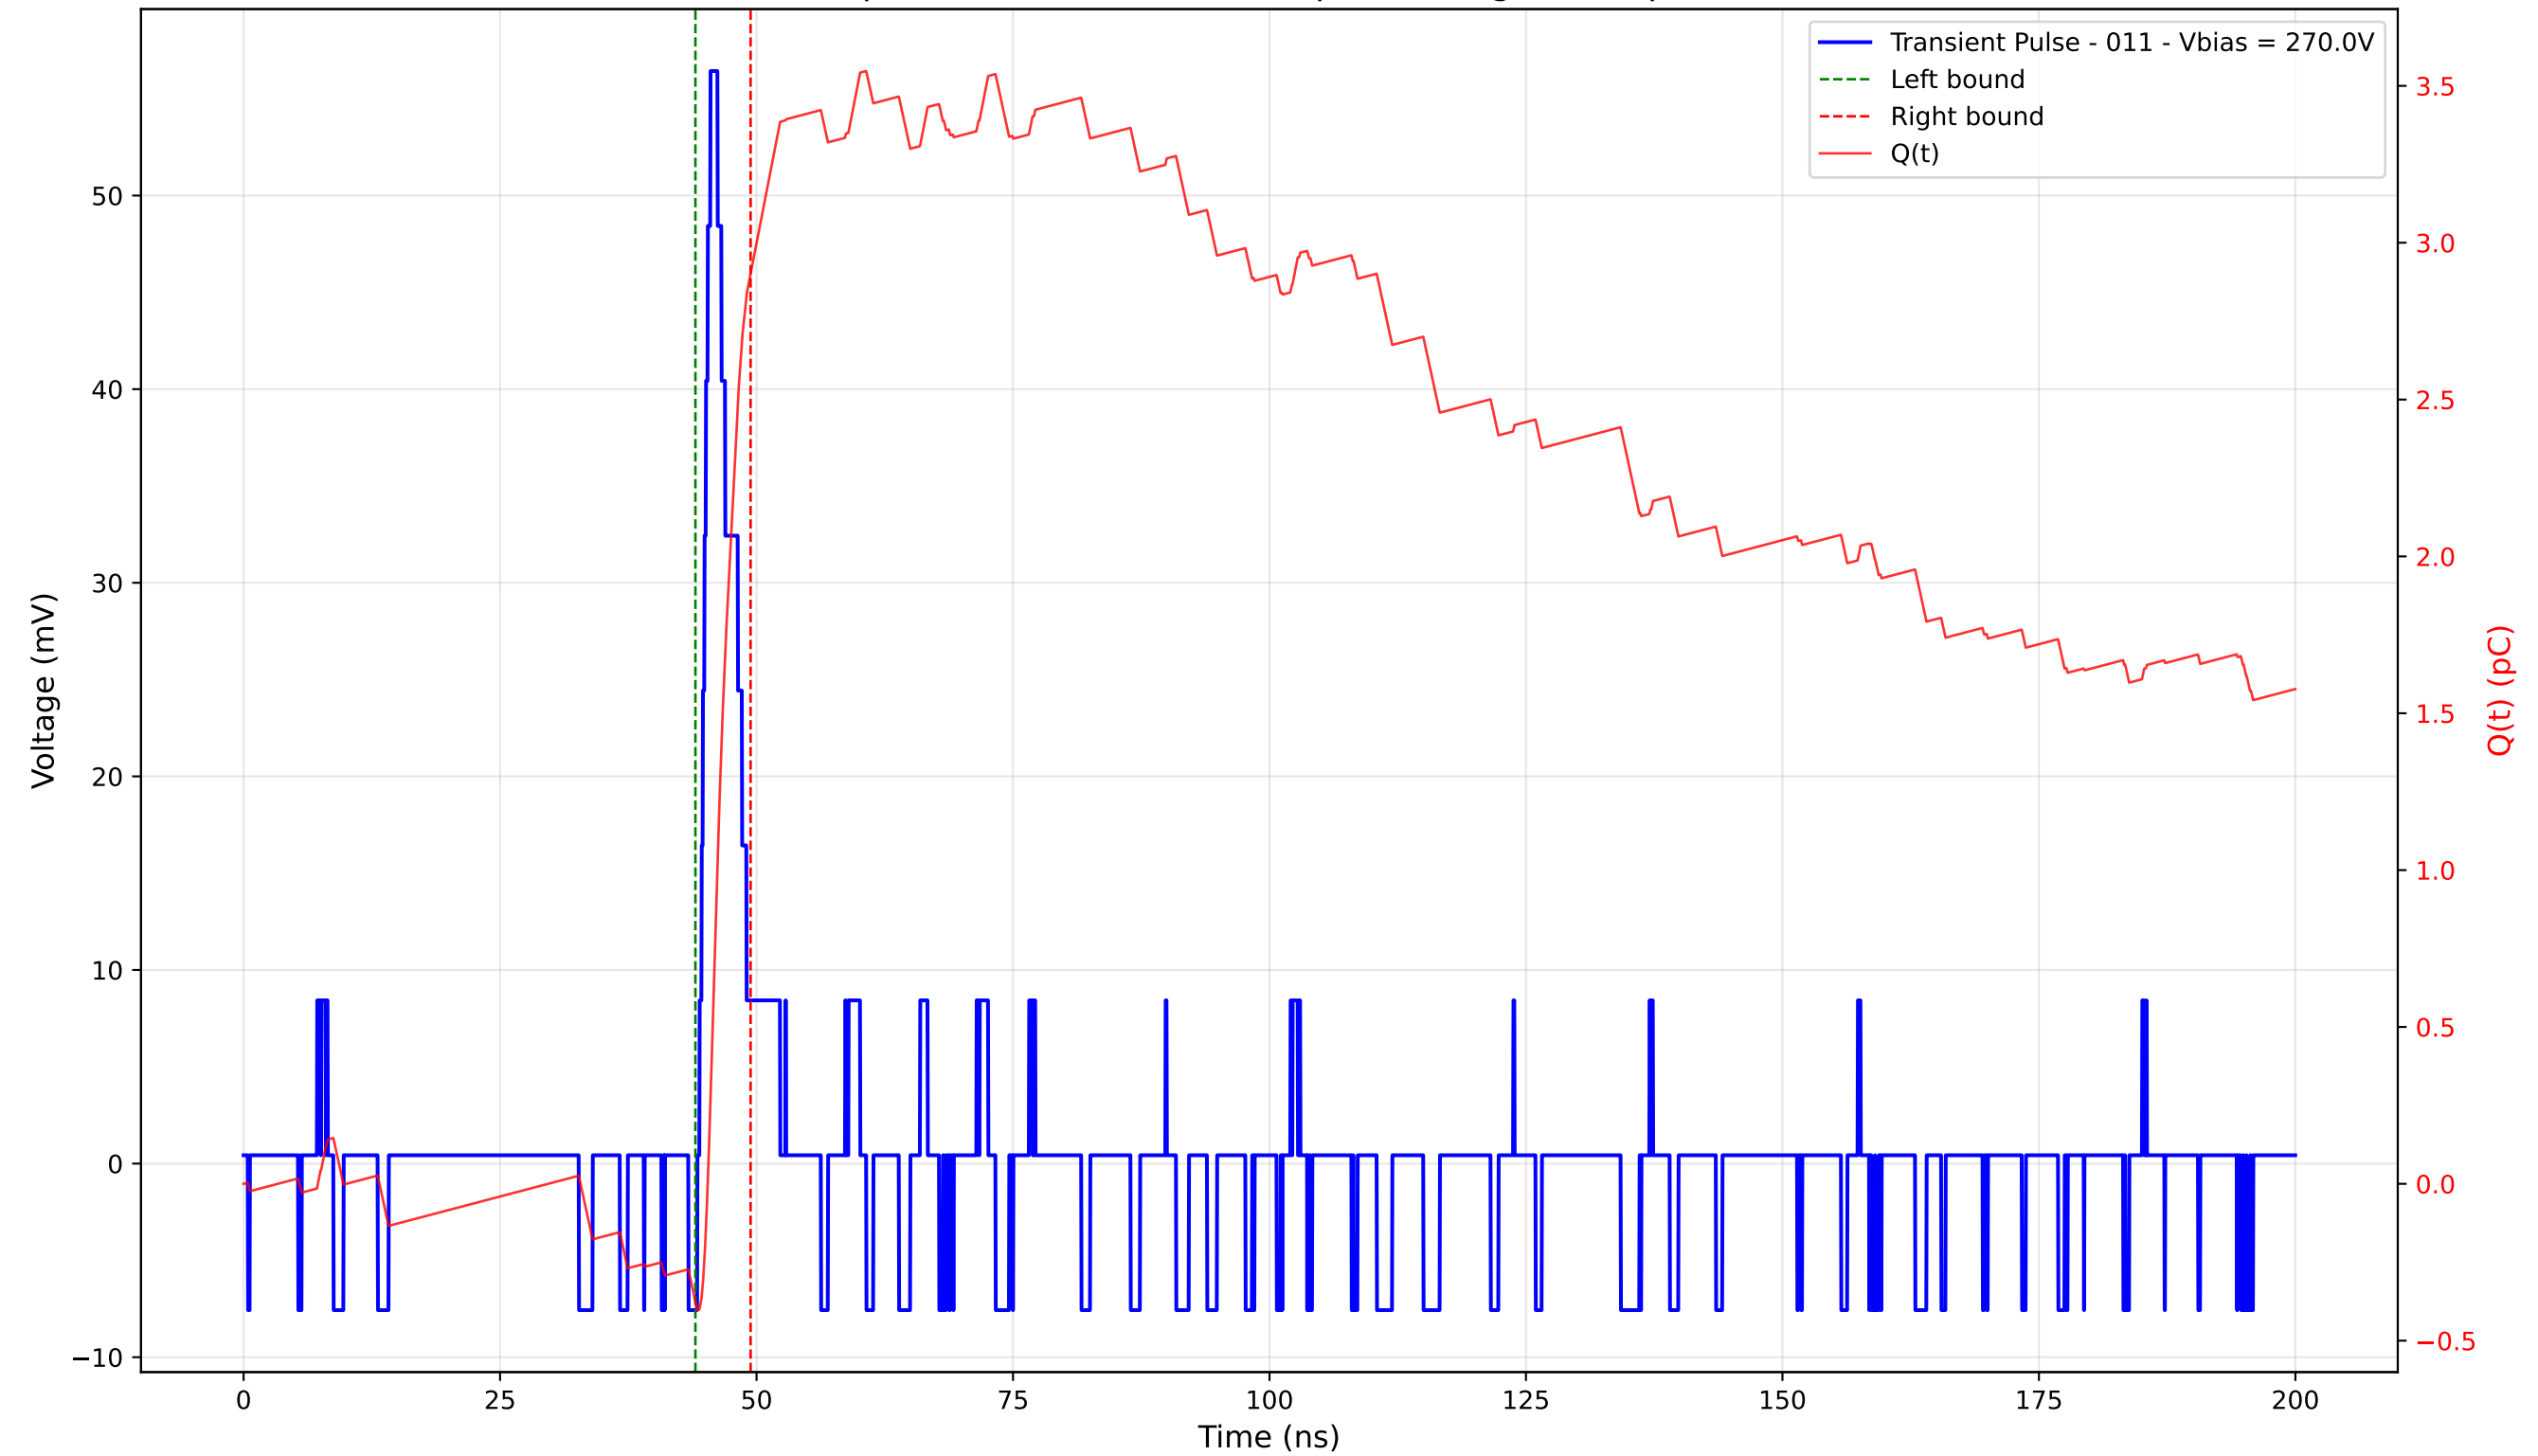


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 2.23 pC - Rise Time: 0.85 ns

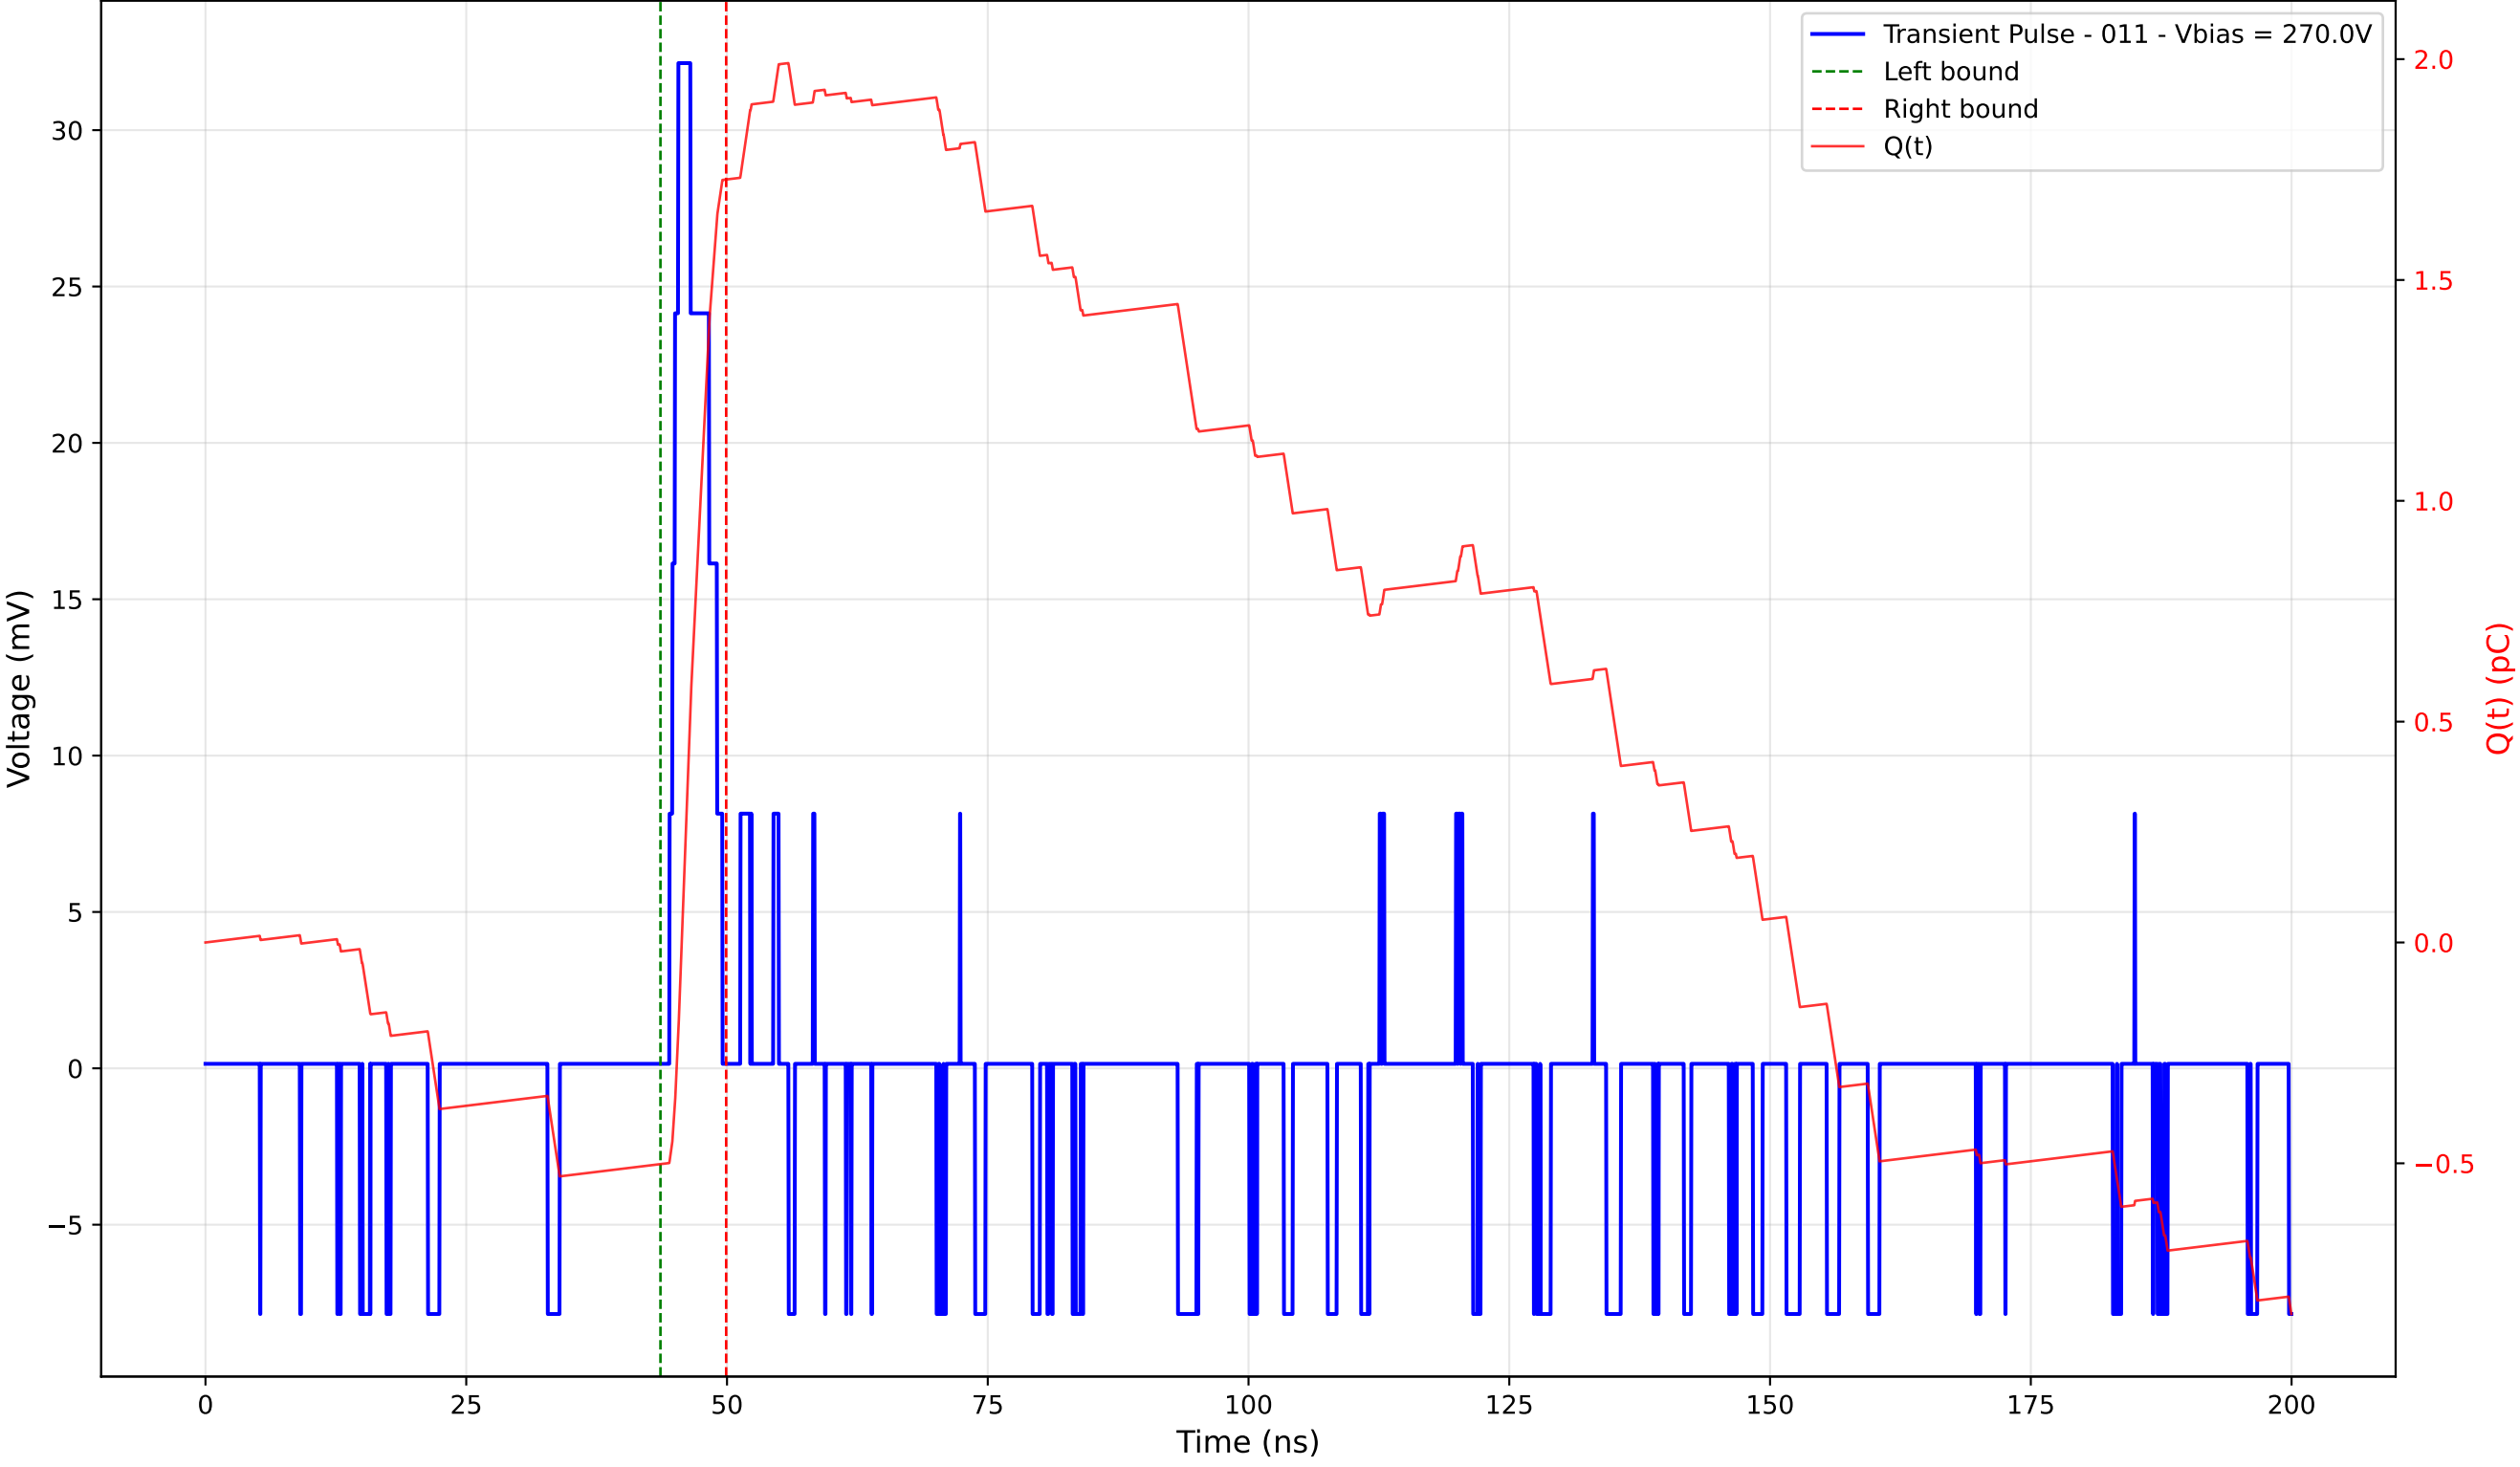


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 1.07 pC - Rise Time: 0.70 ns

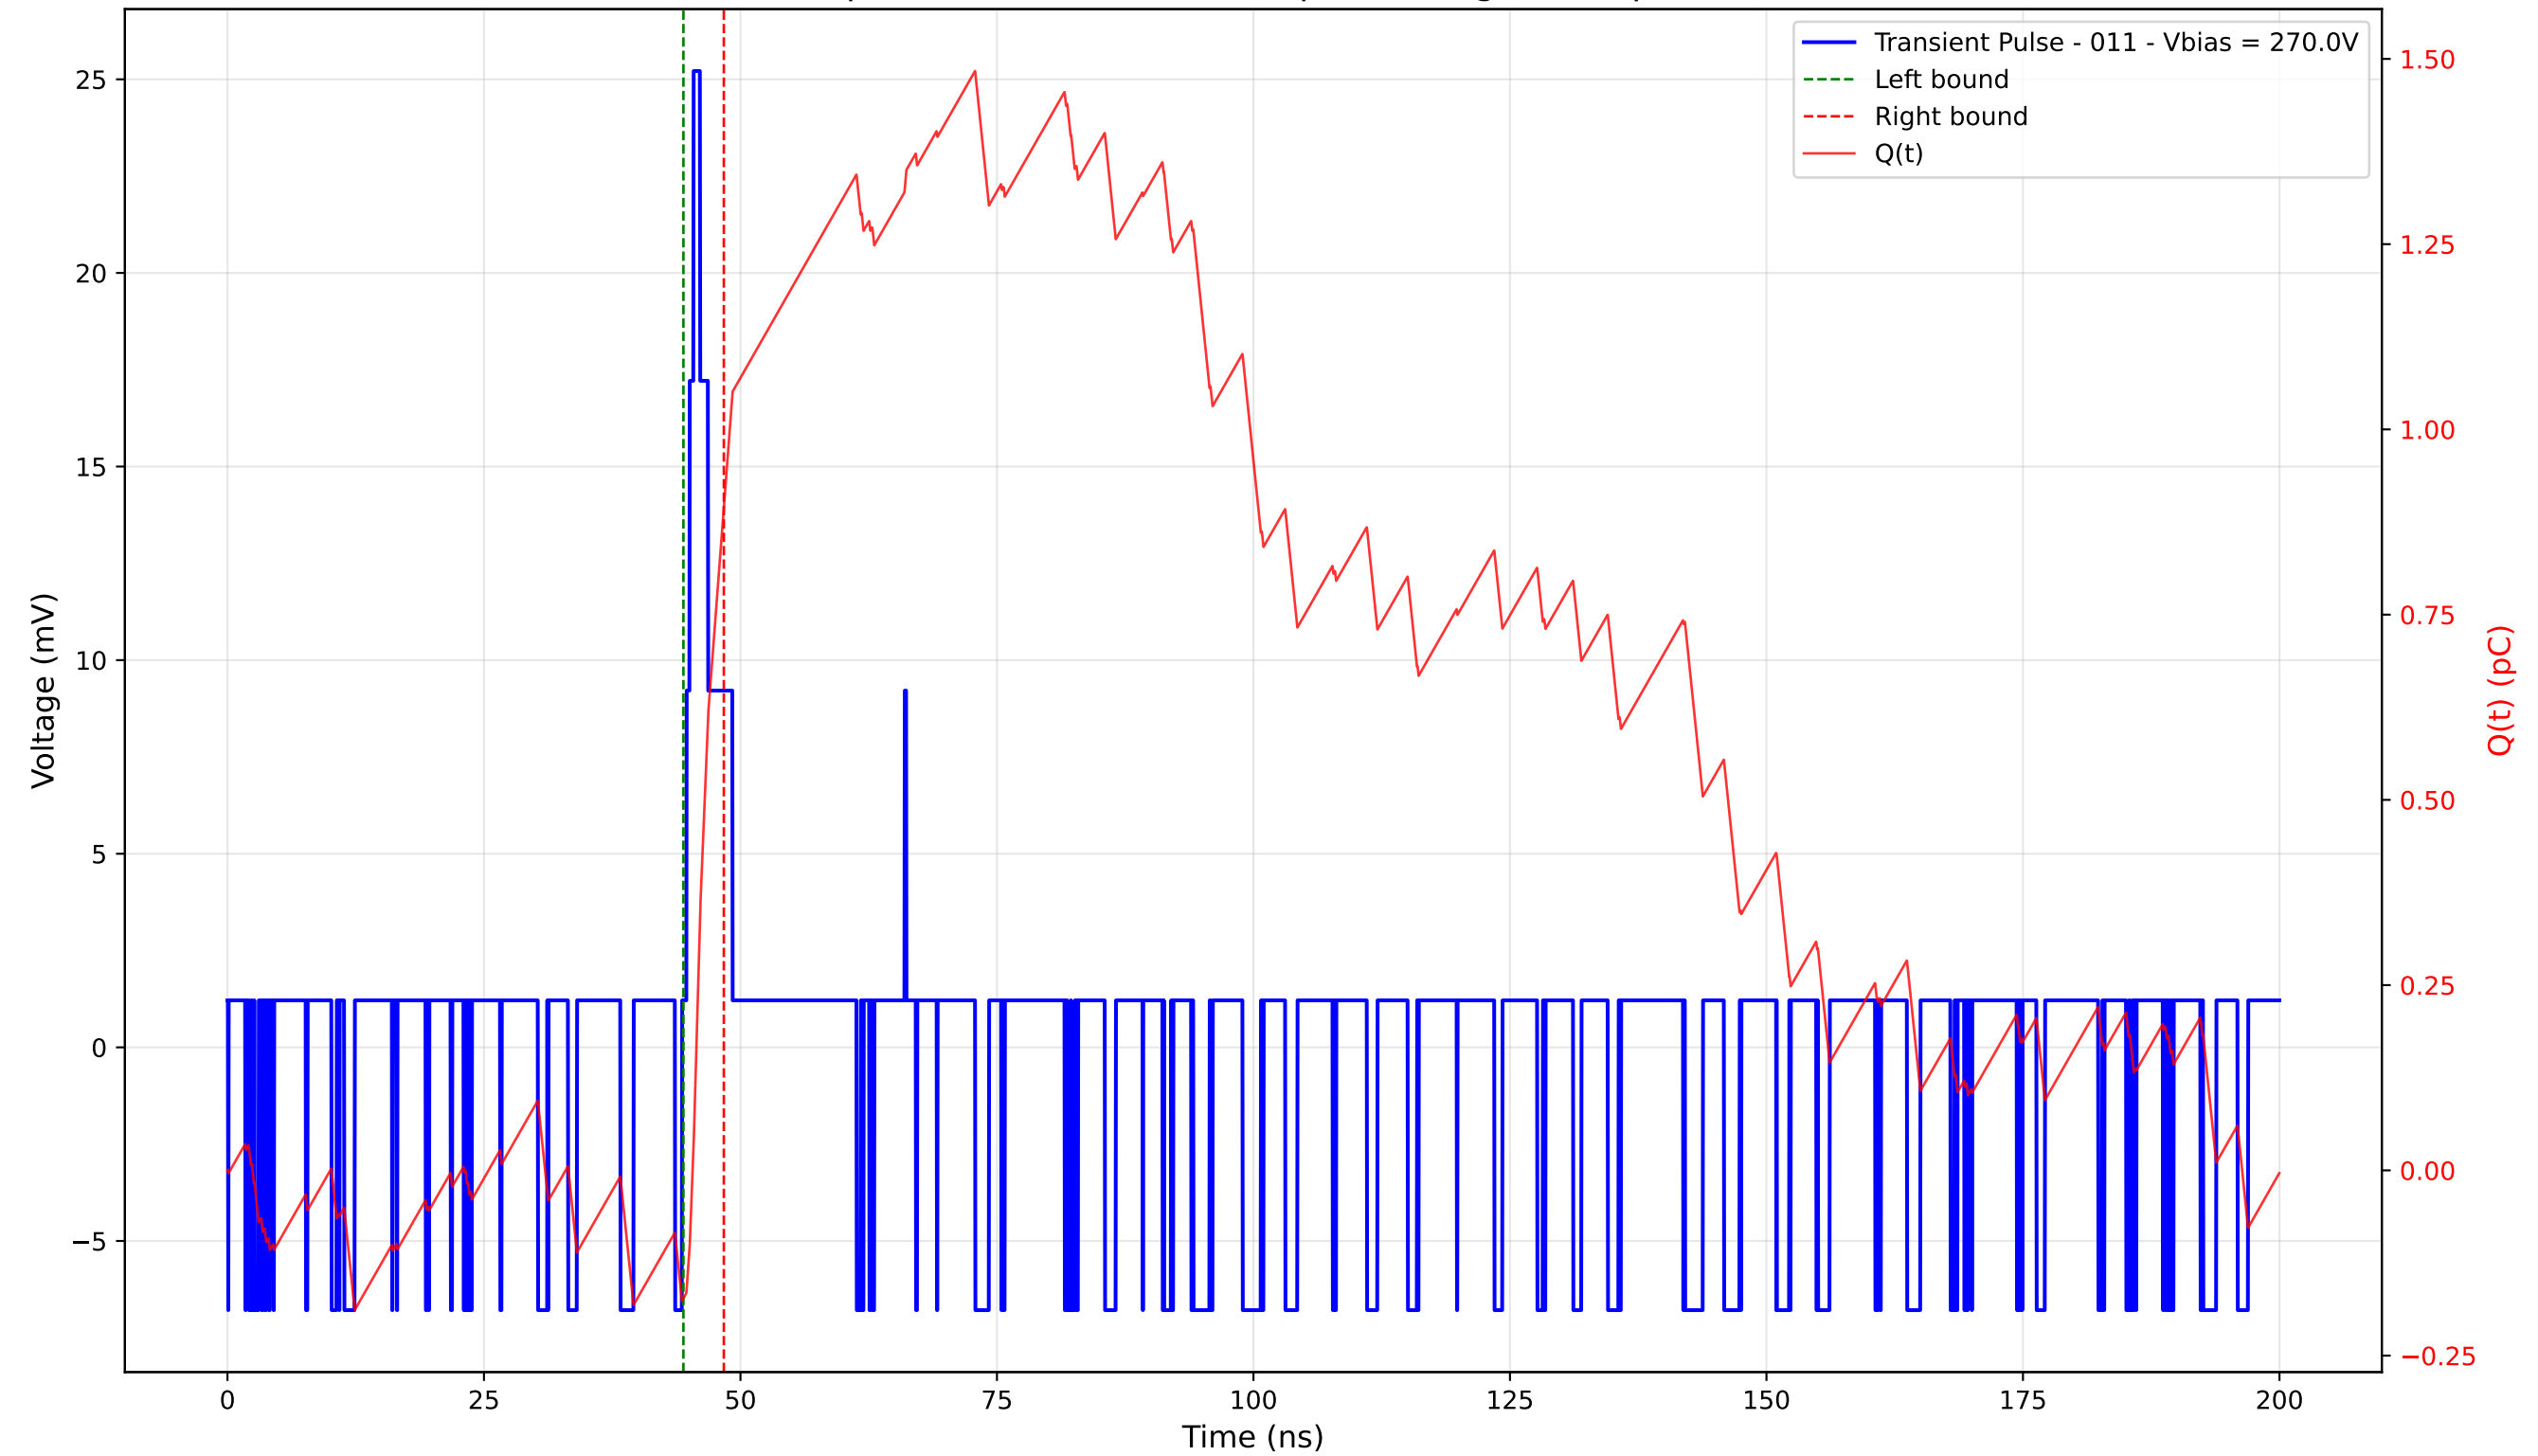


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 0.46 pC - Rise Time: 0.46 ns

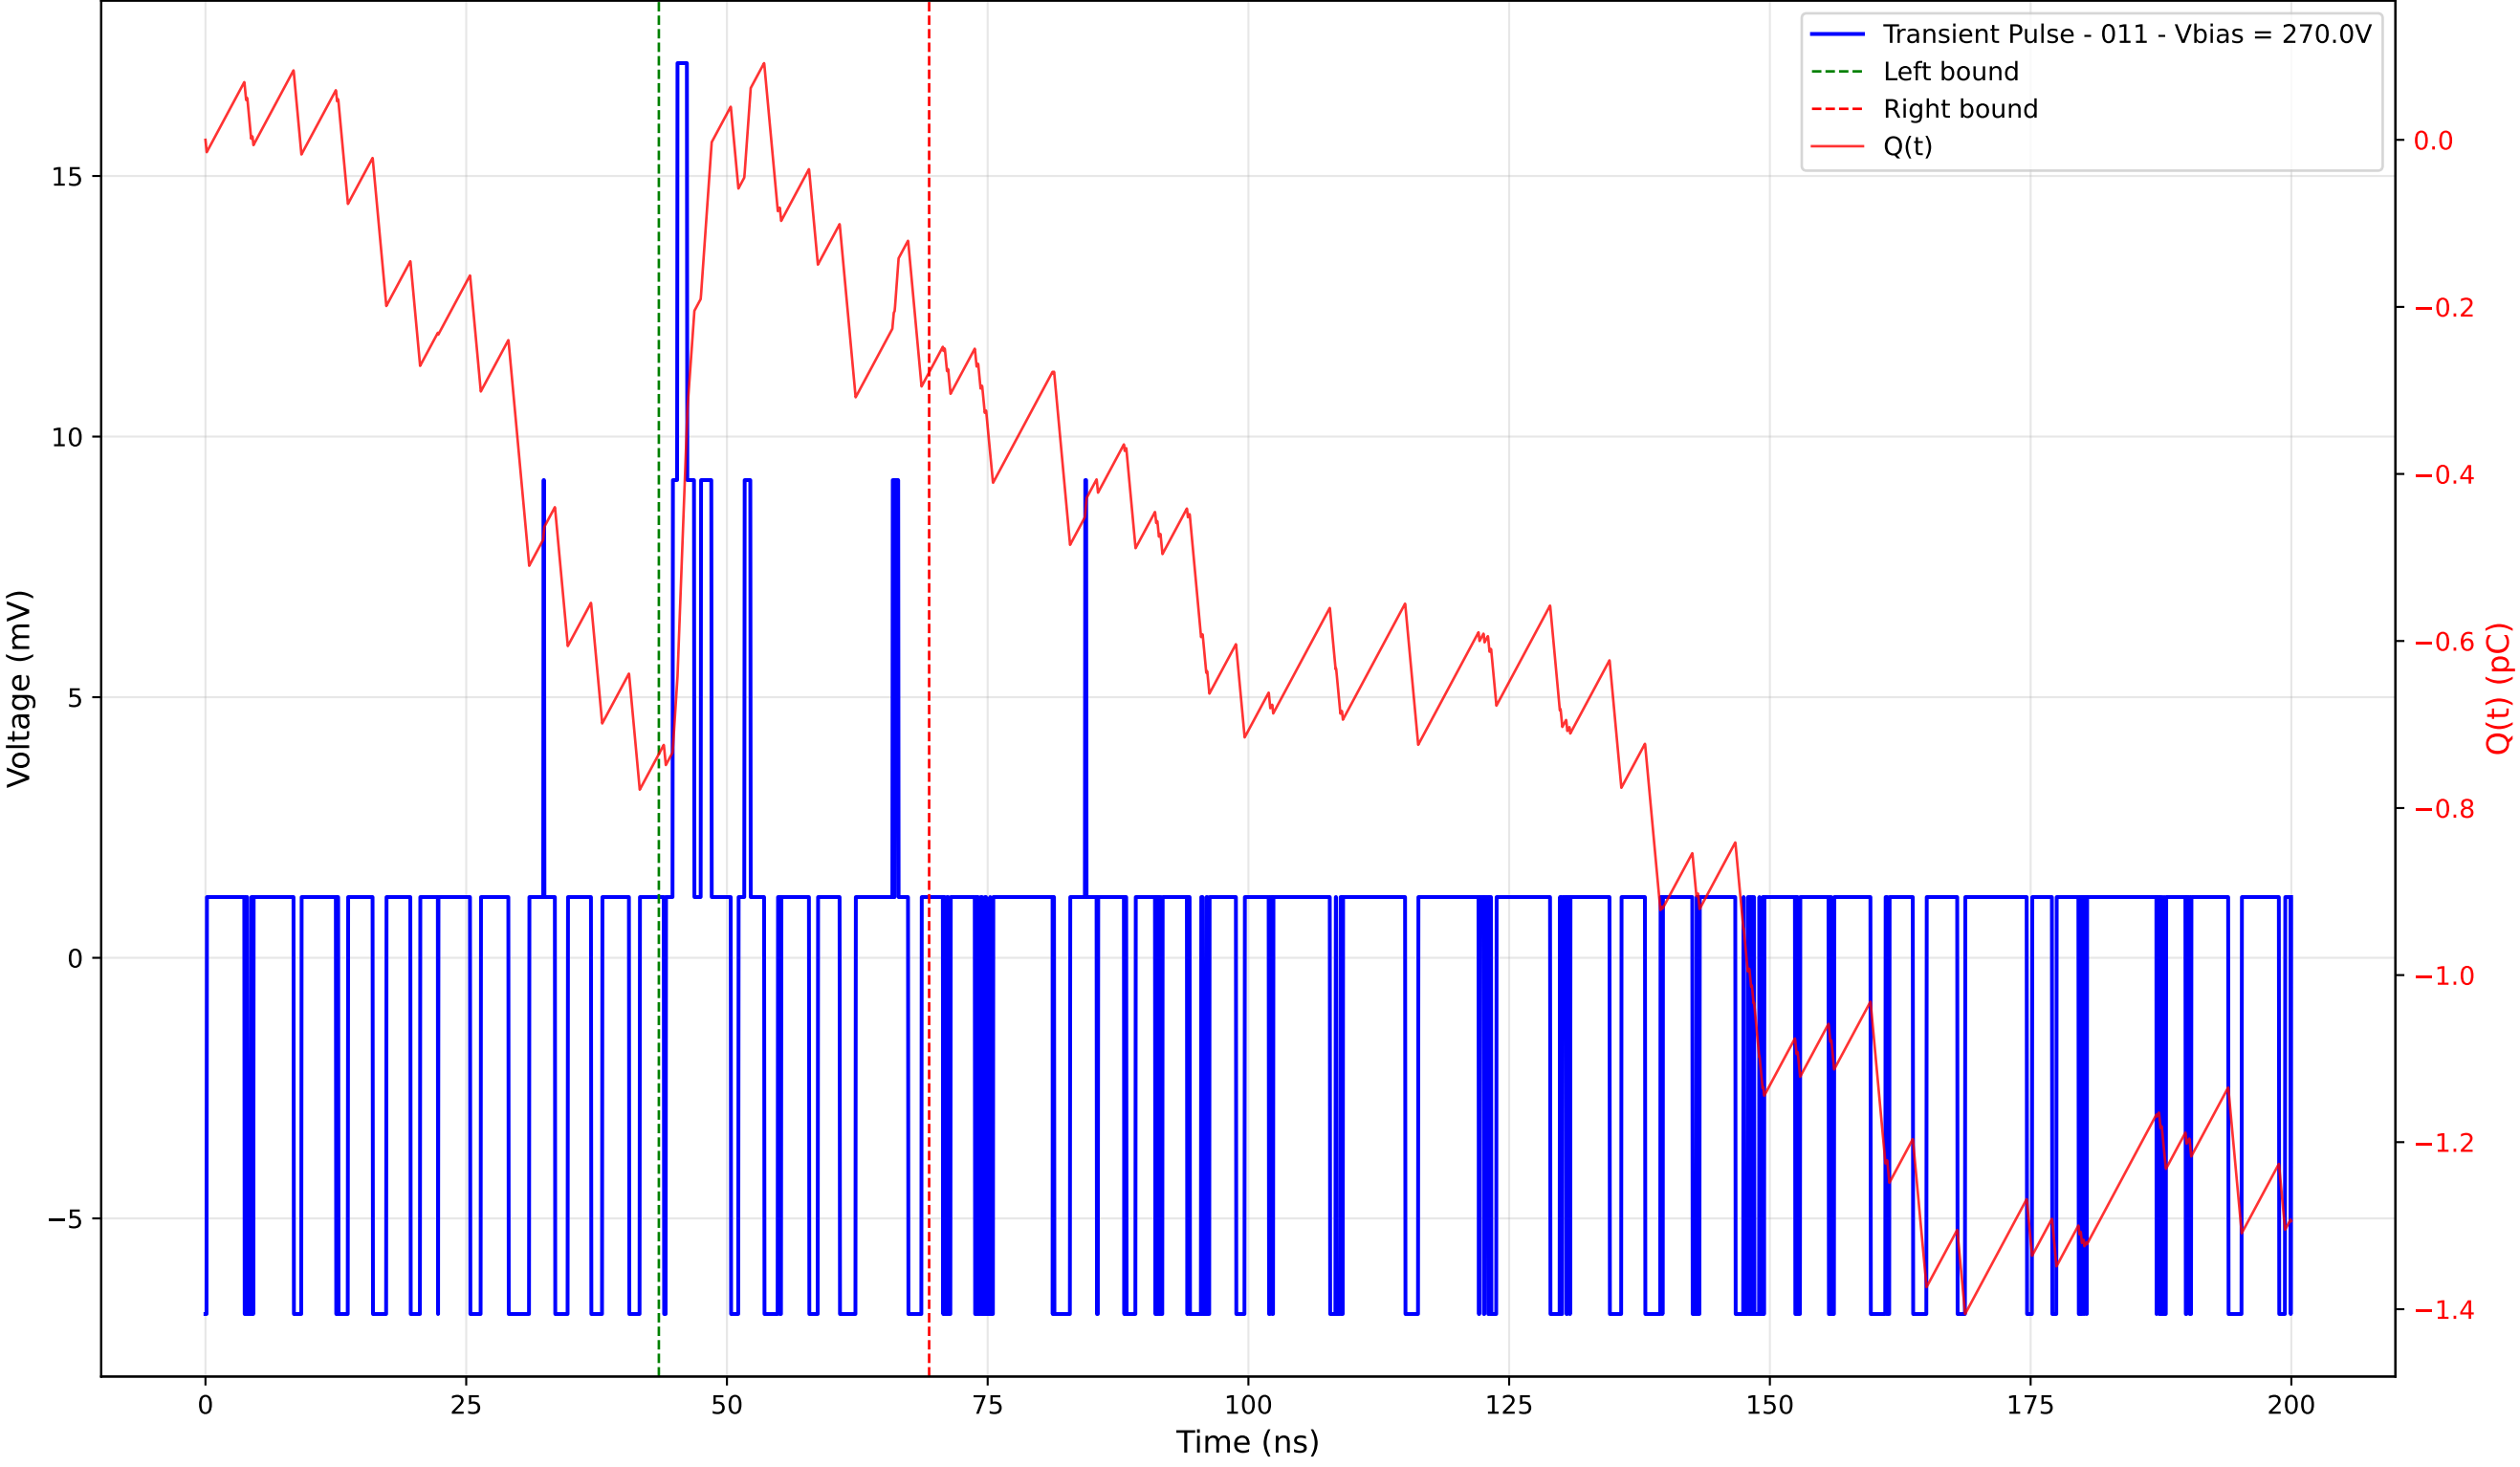


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 1.10 pC - Rise Time: 0.66 ns

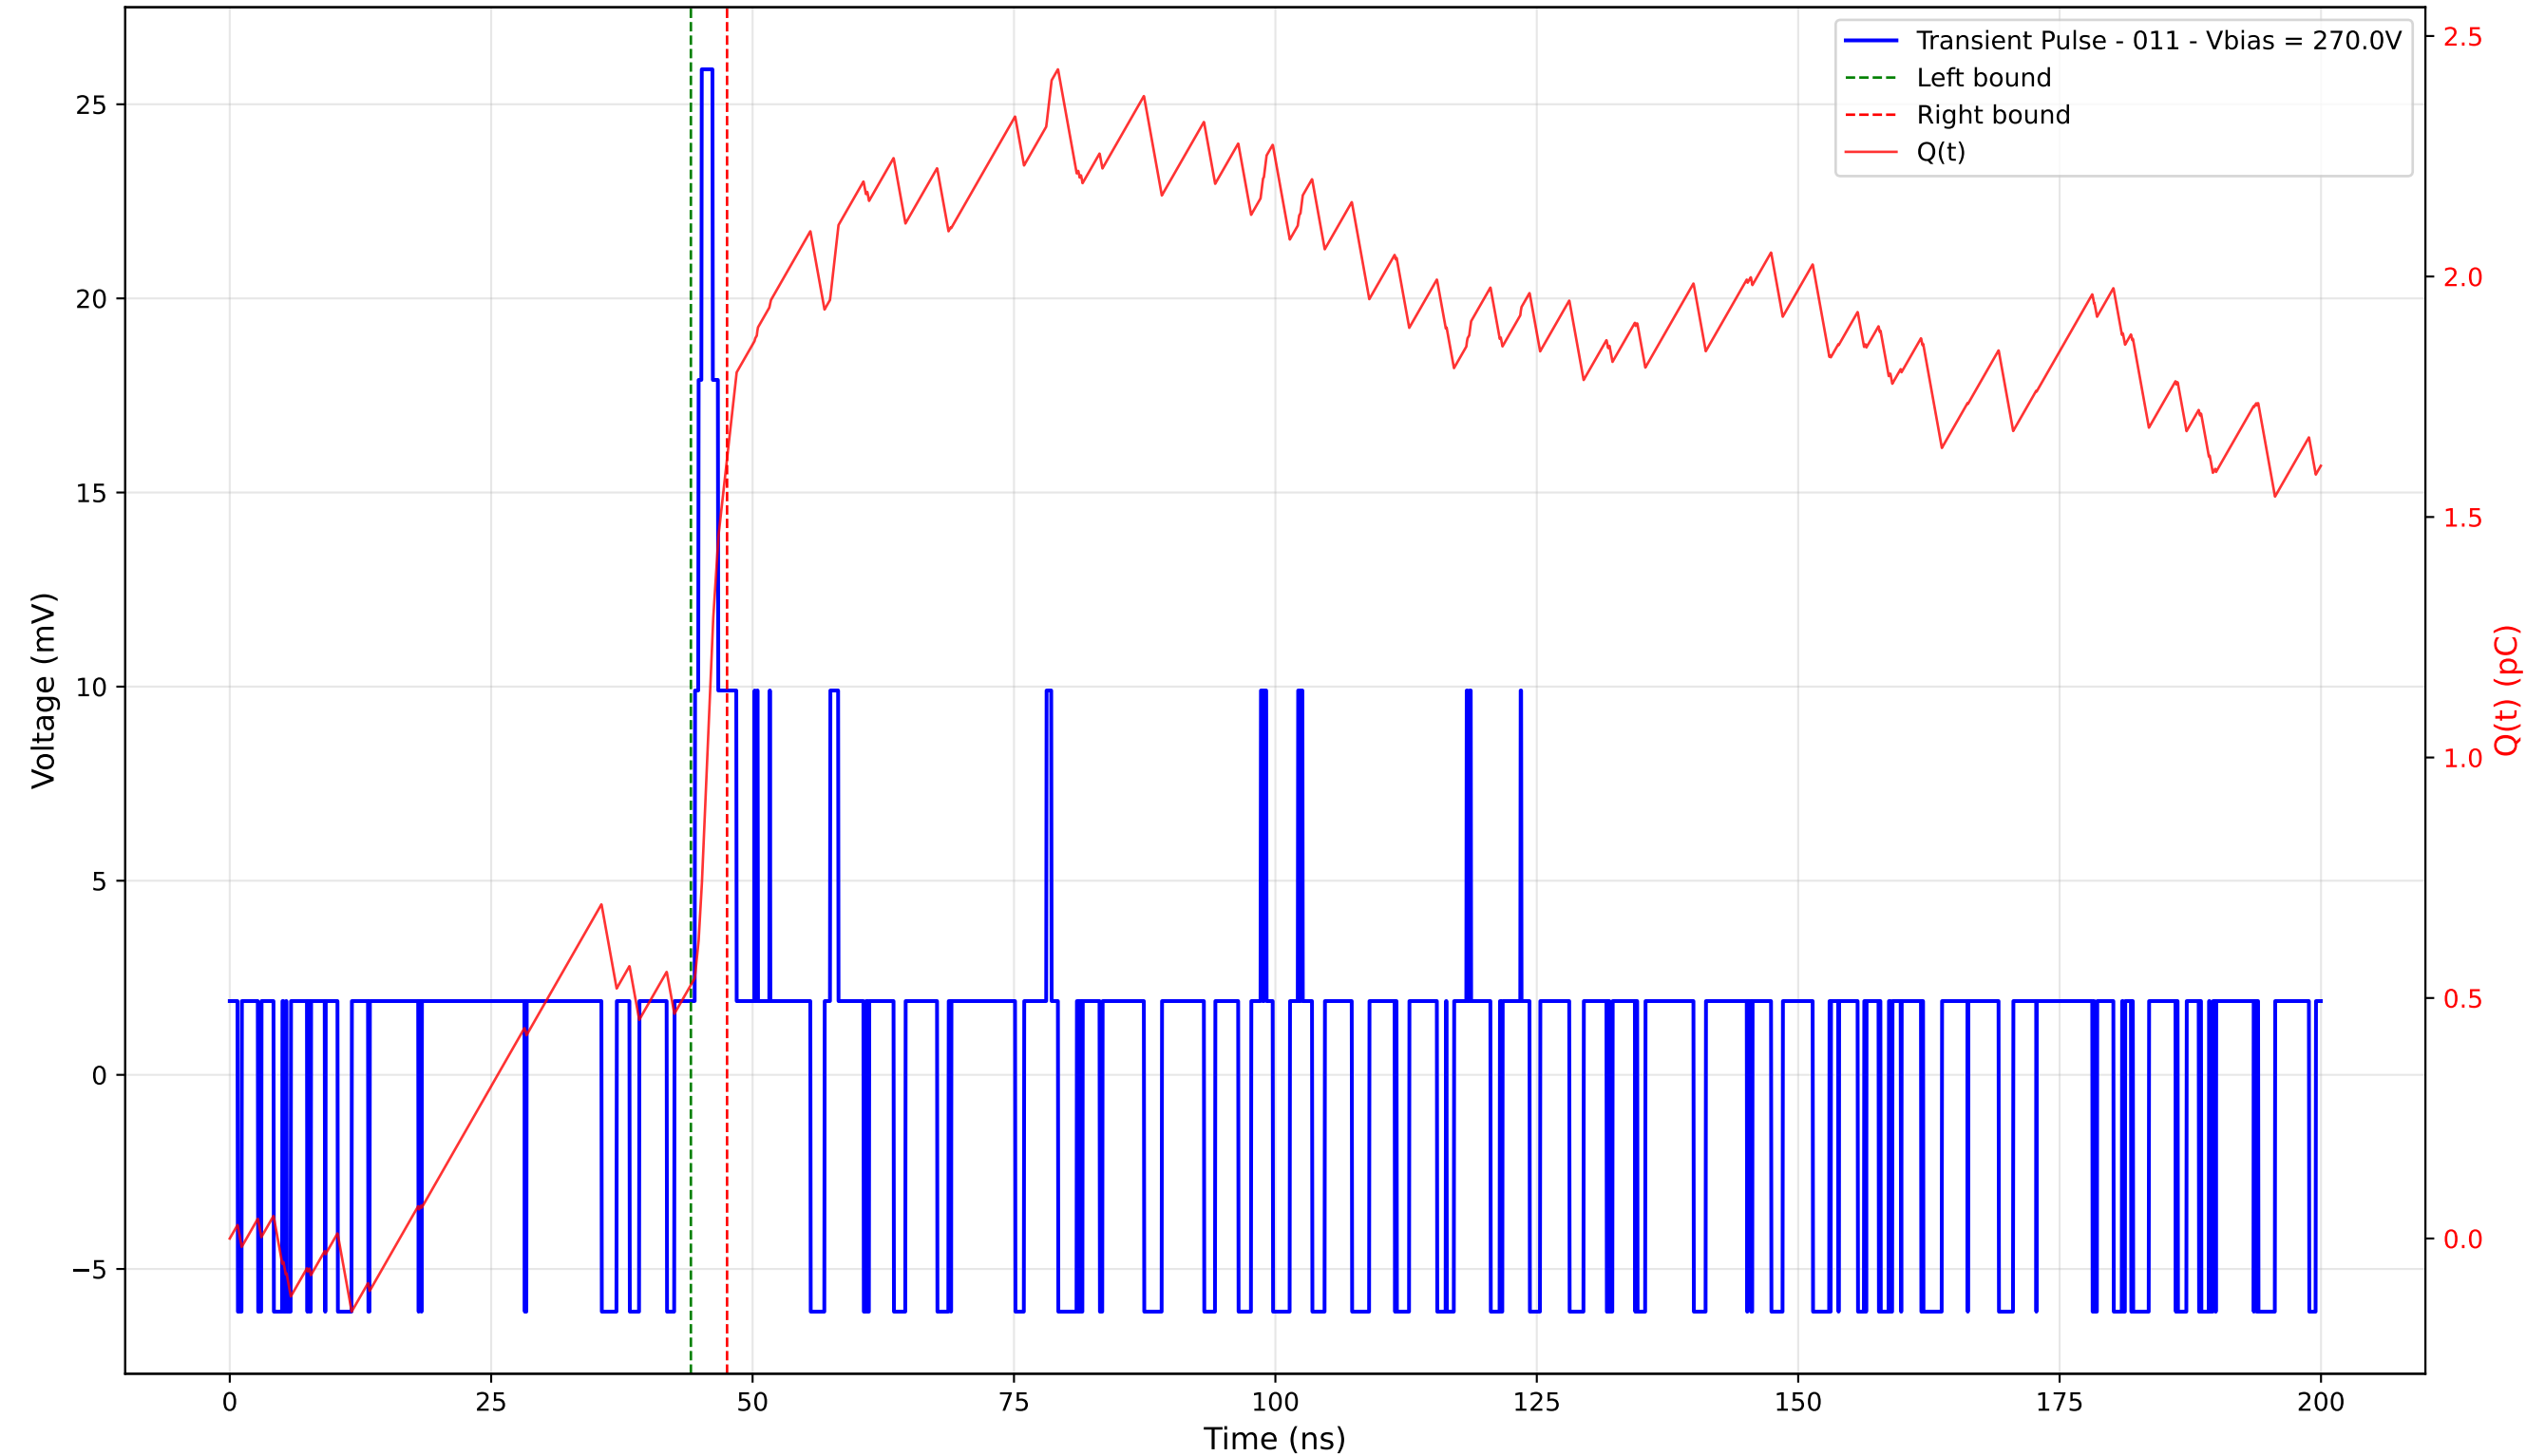


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.24 pC - Rise Time: 0.77 ns

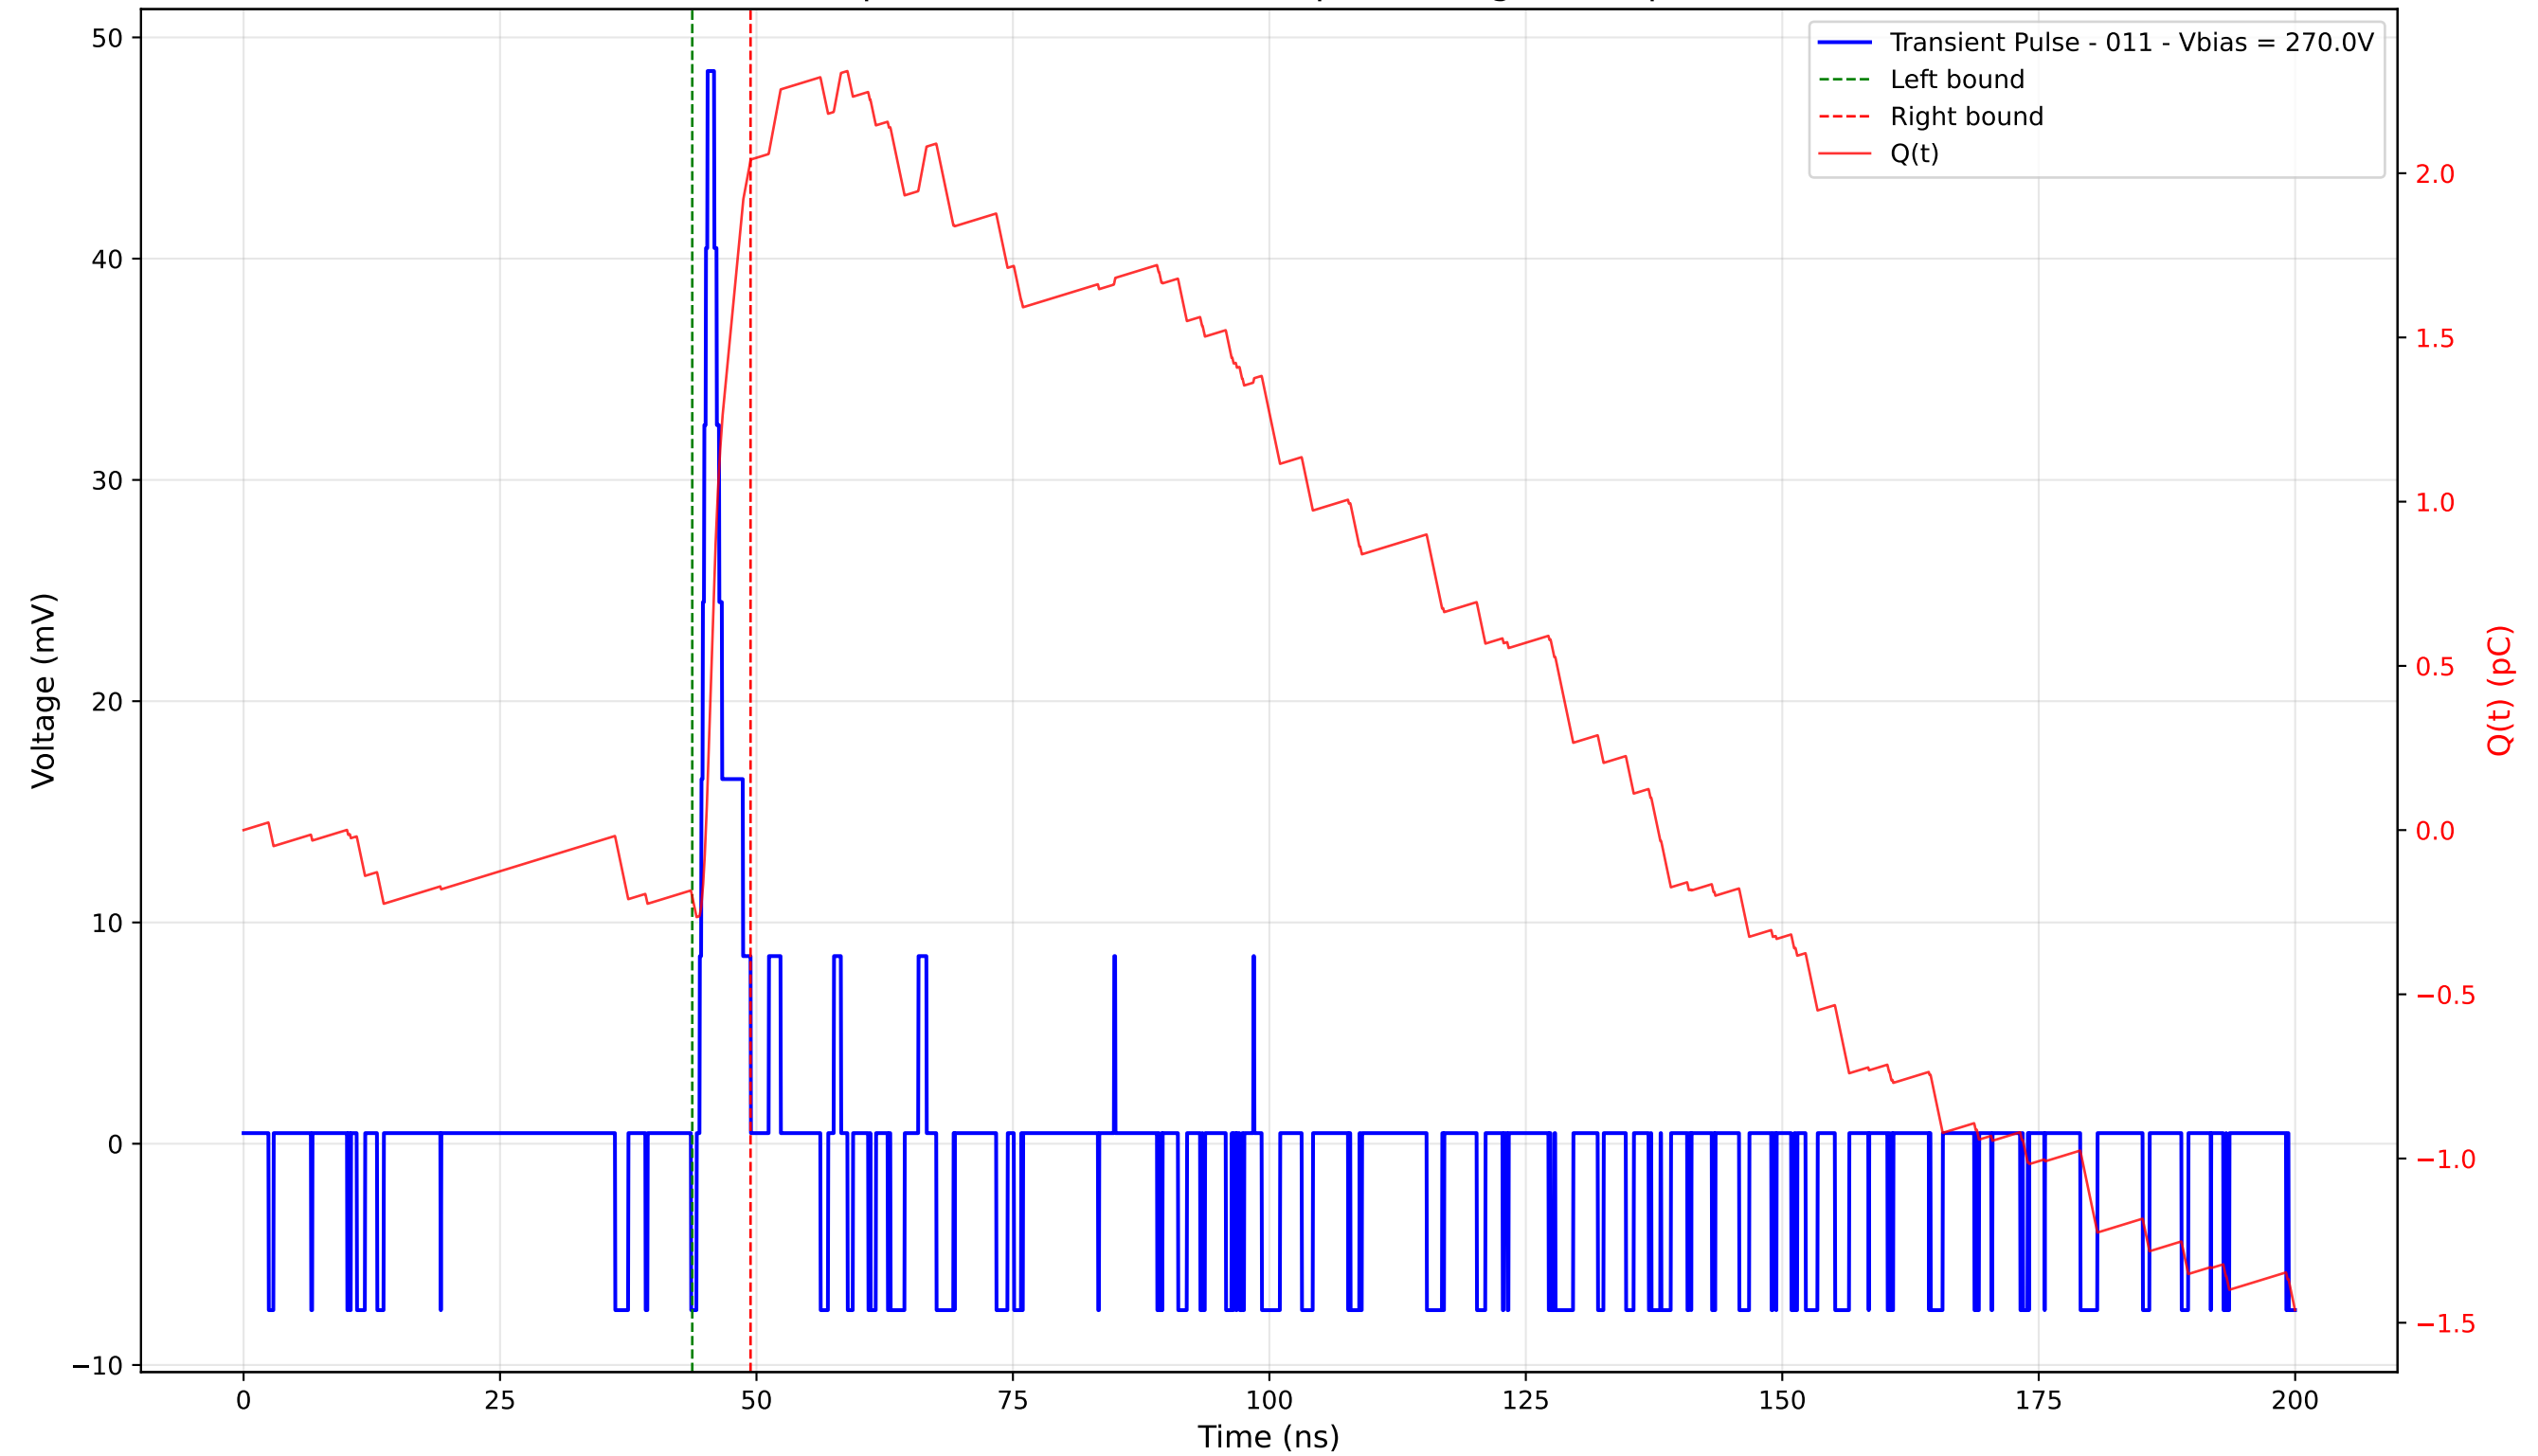


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 5.22 pC - Rise Time: 0.82 ns

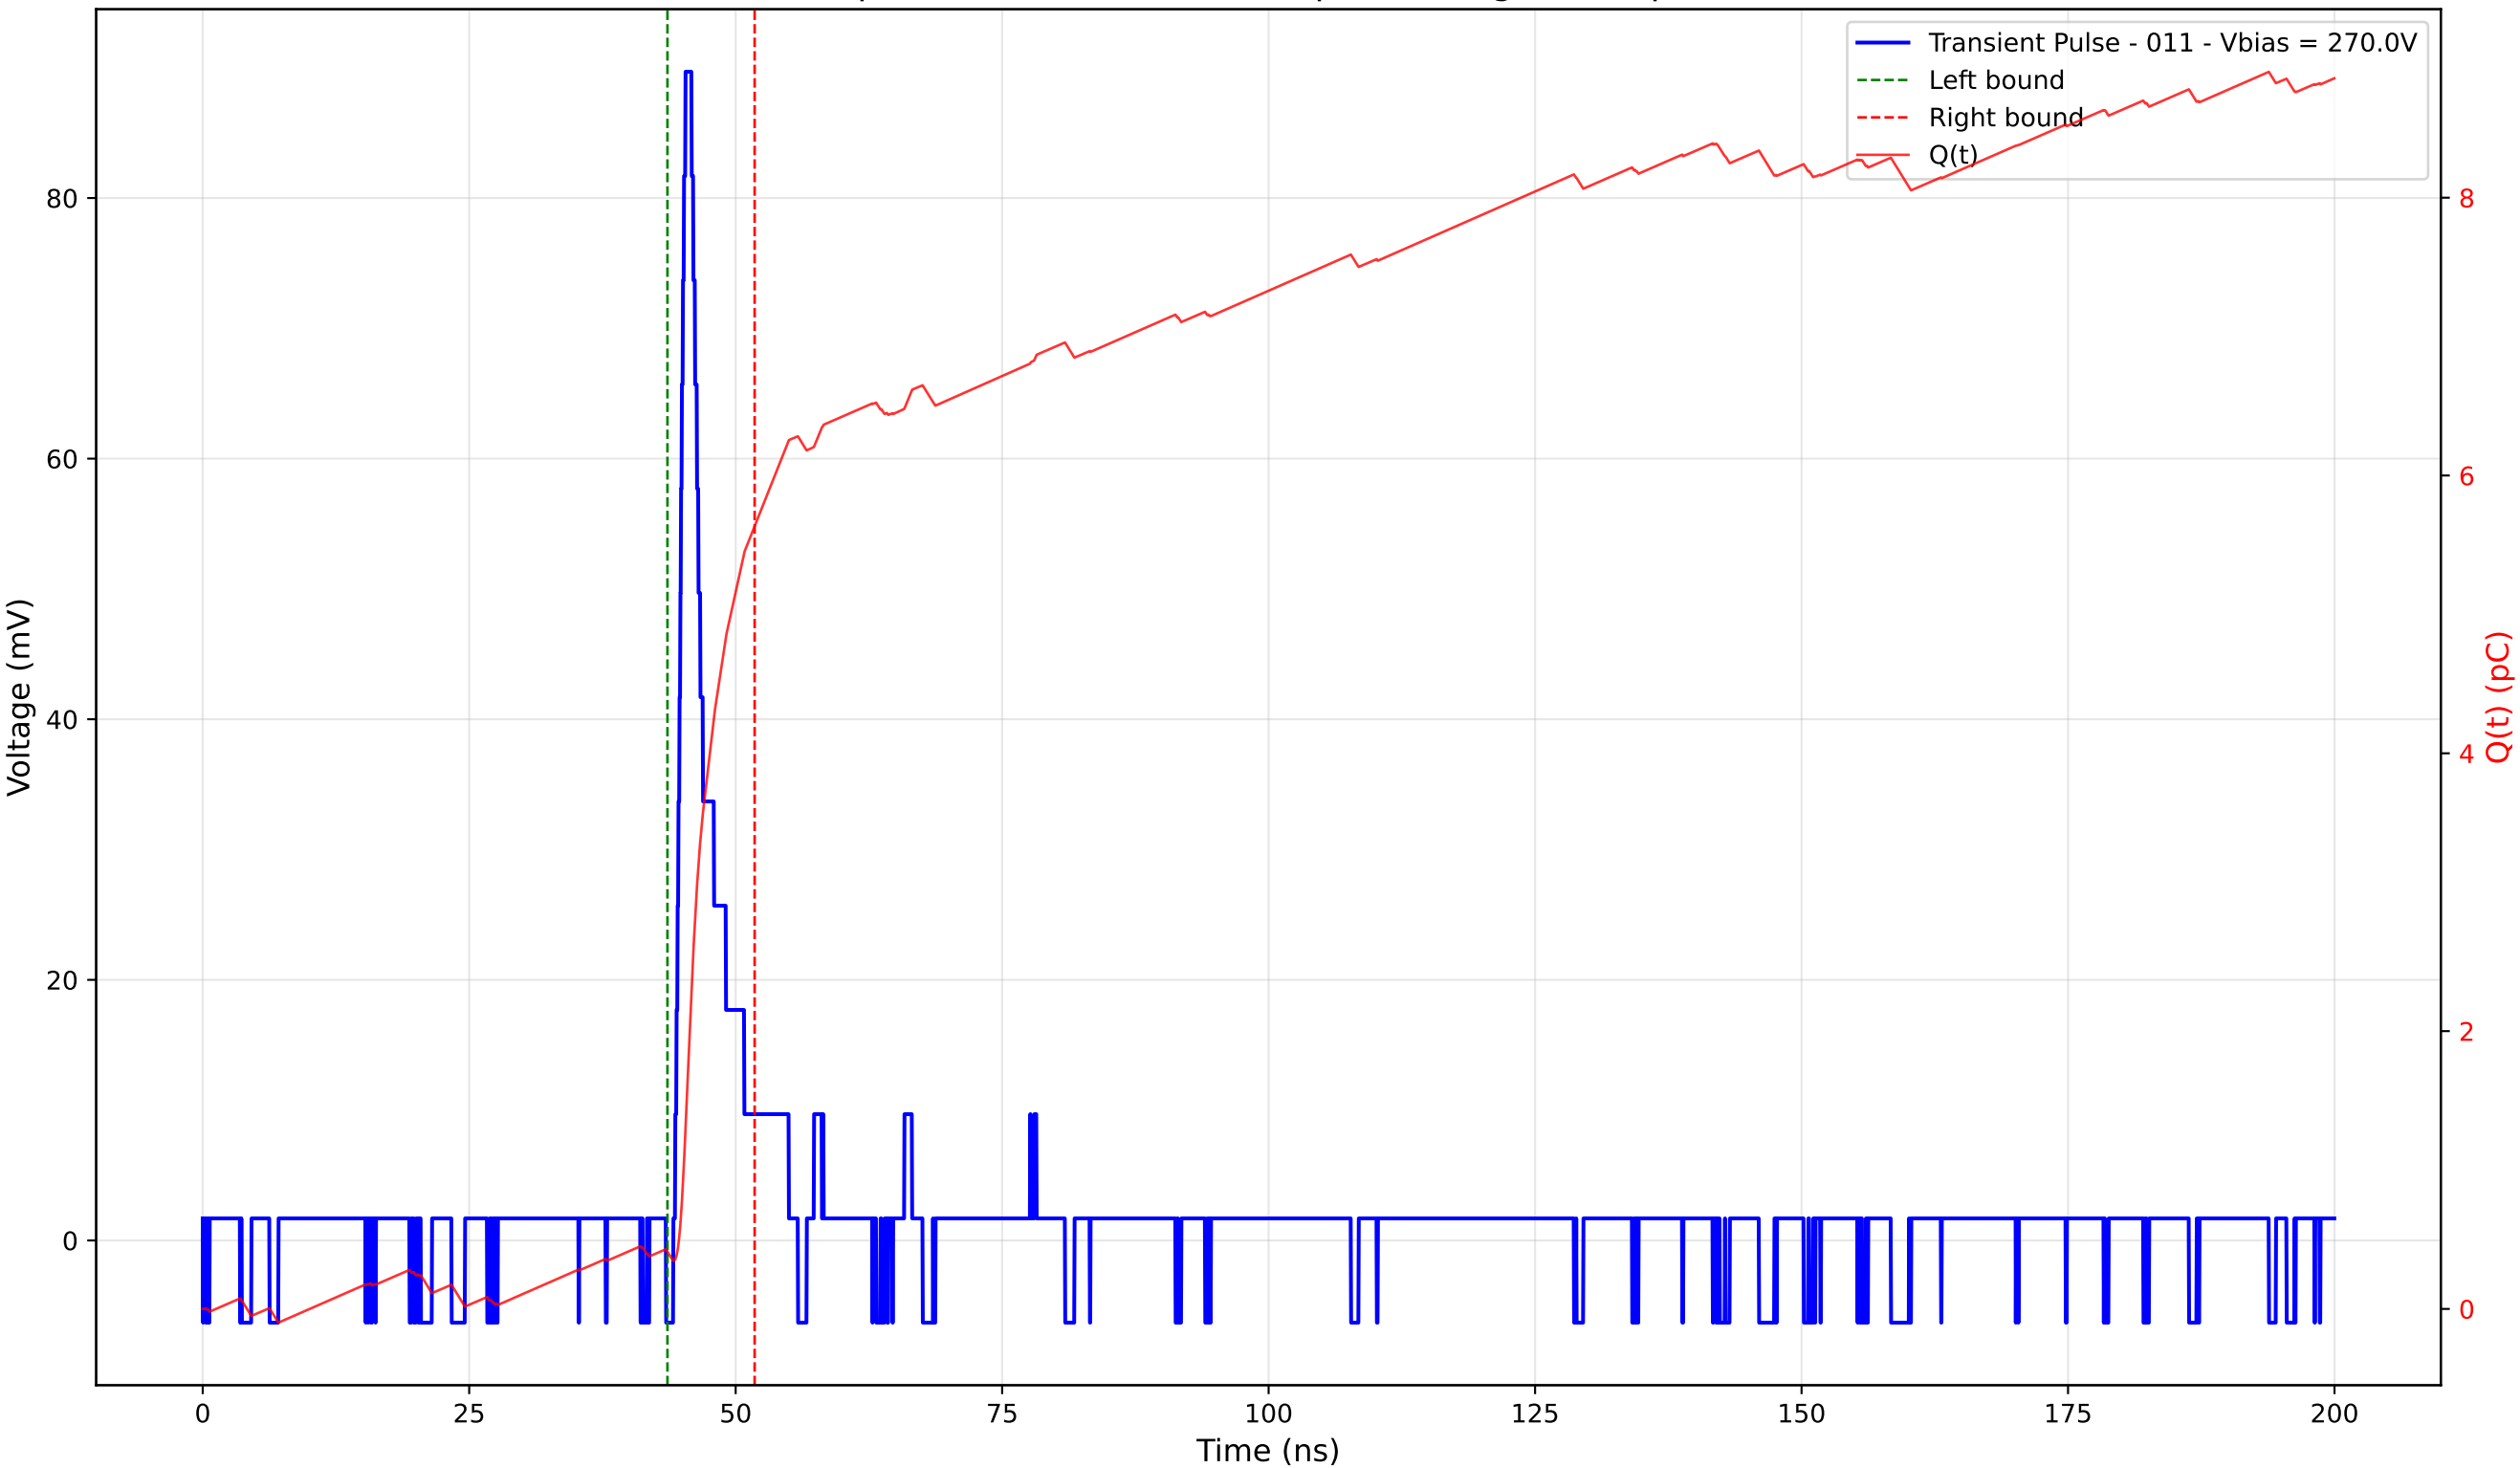


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 10.13 pC - Rise Time: 0.88 ns

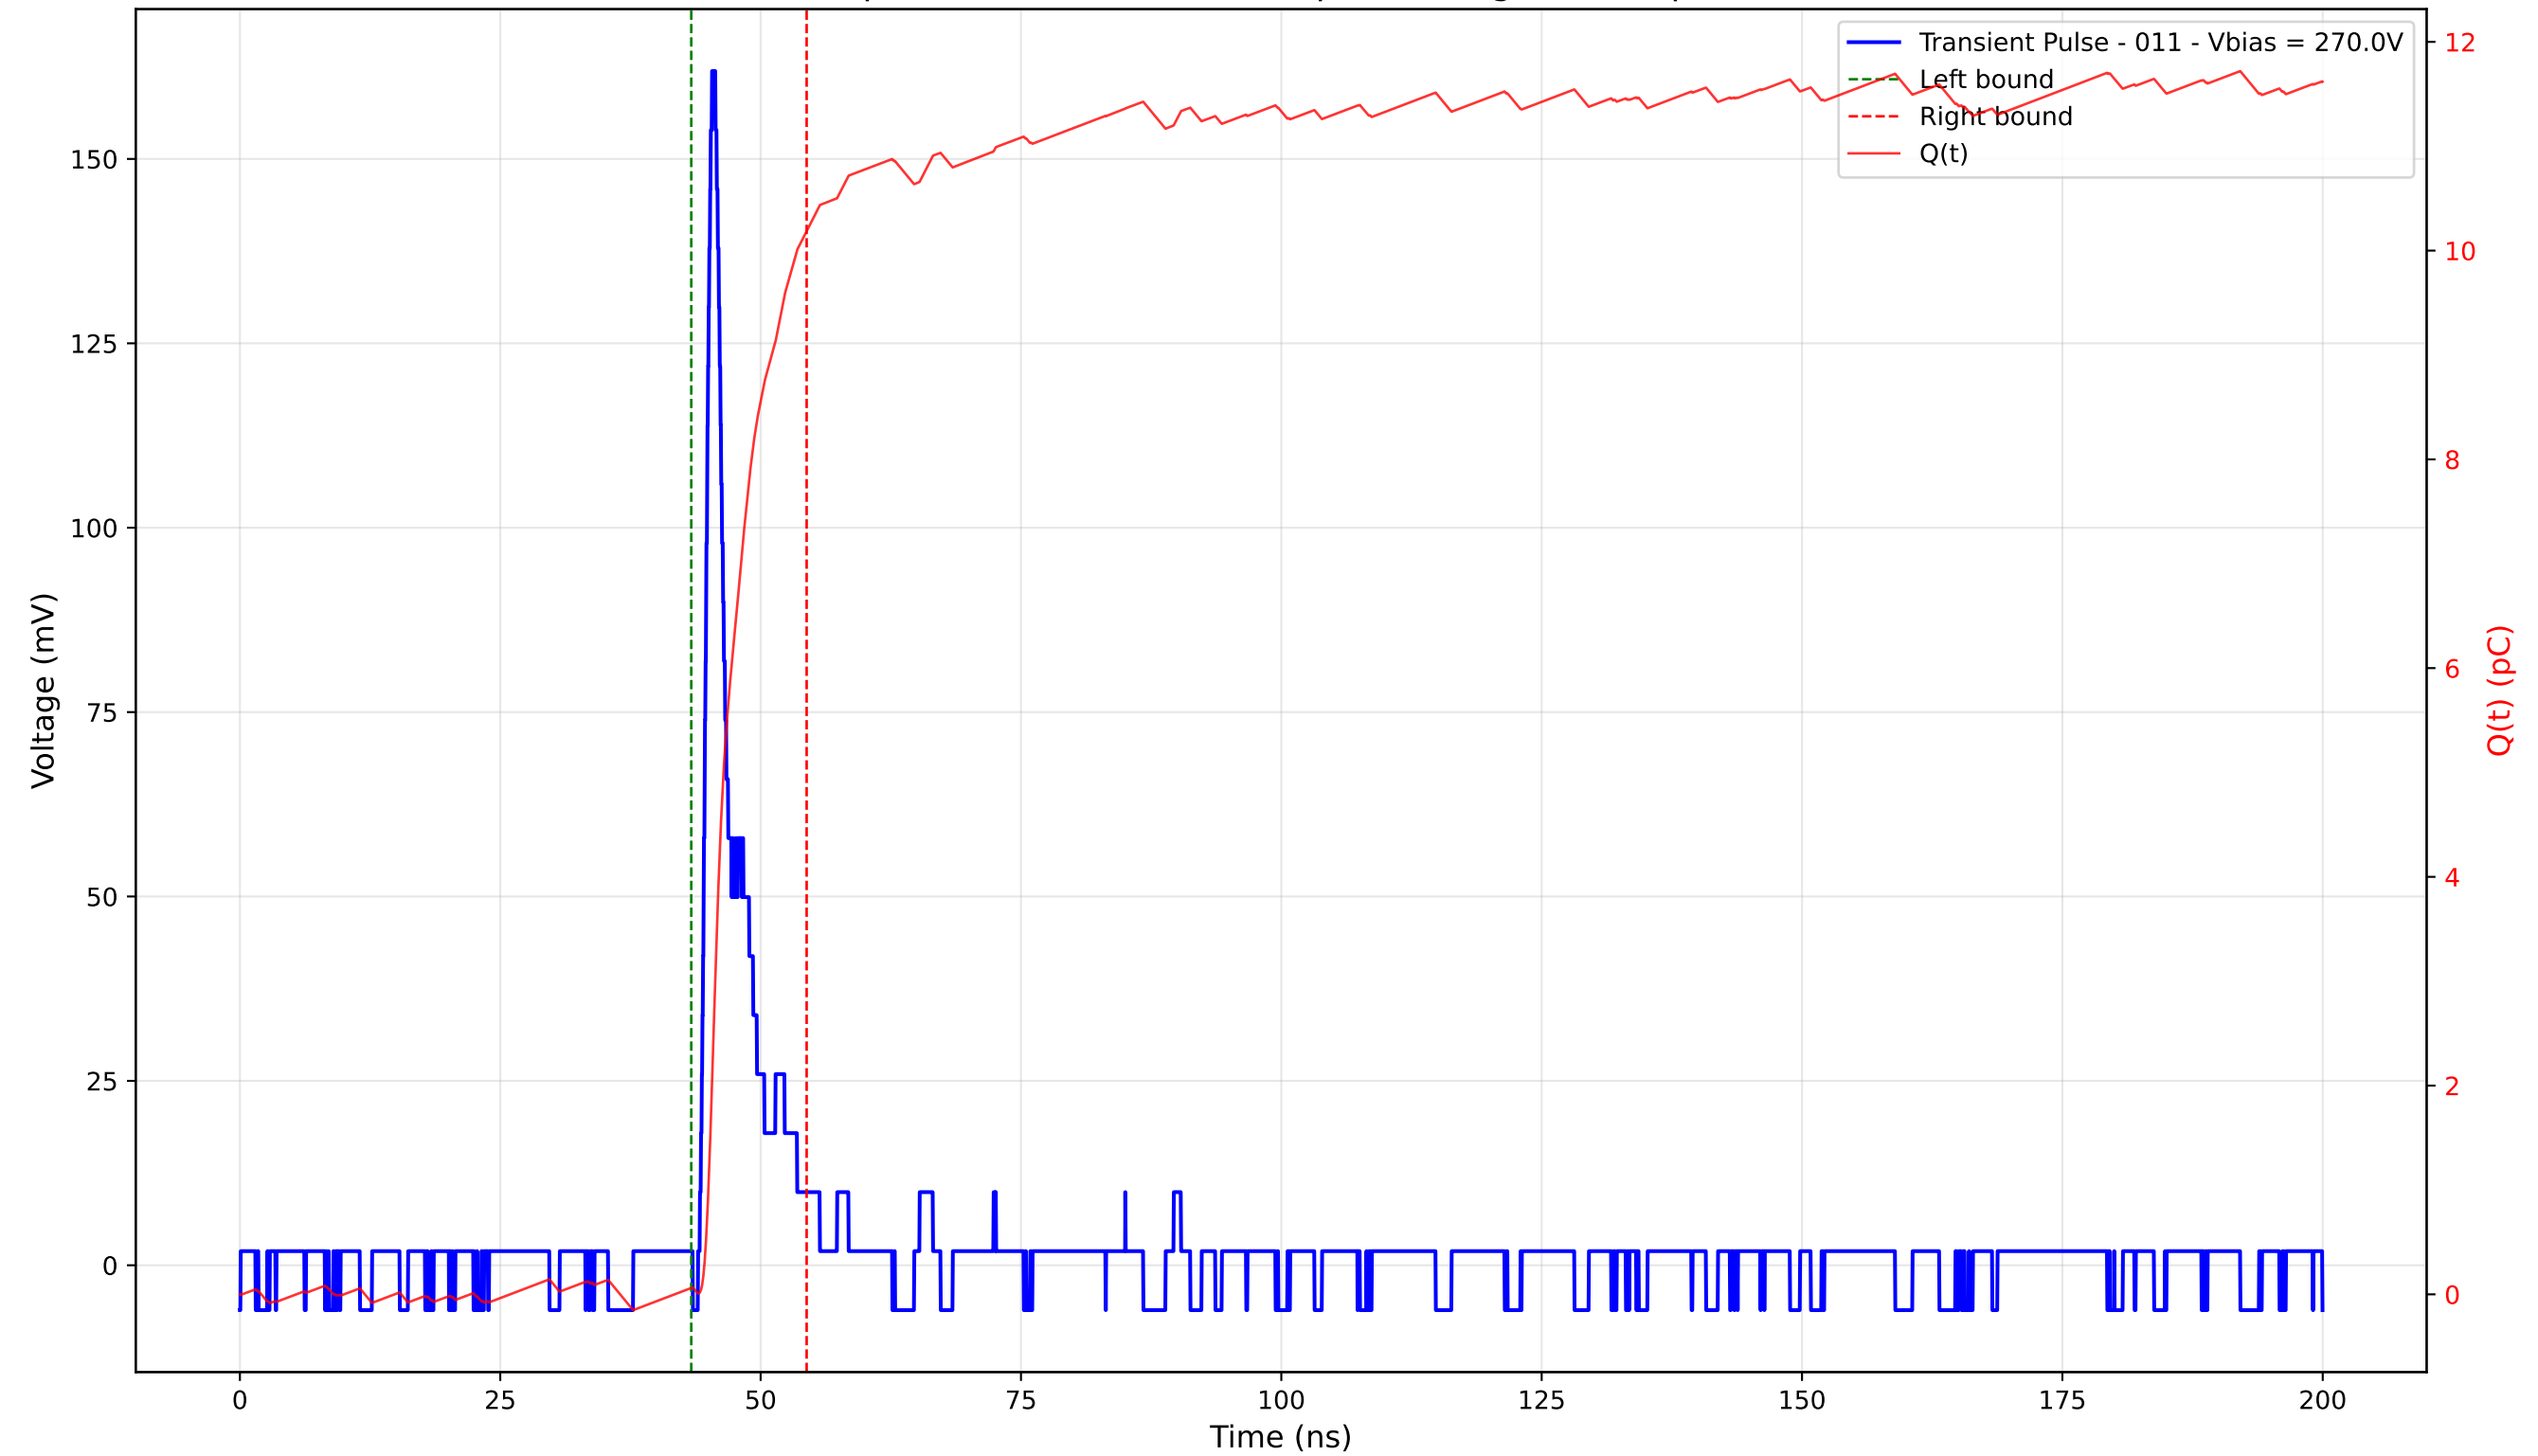


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 14.71 pC - Rise Time: 0.92 ns

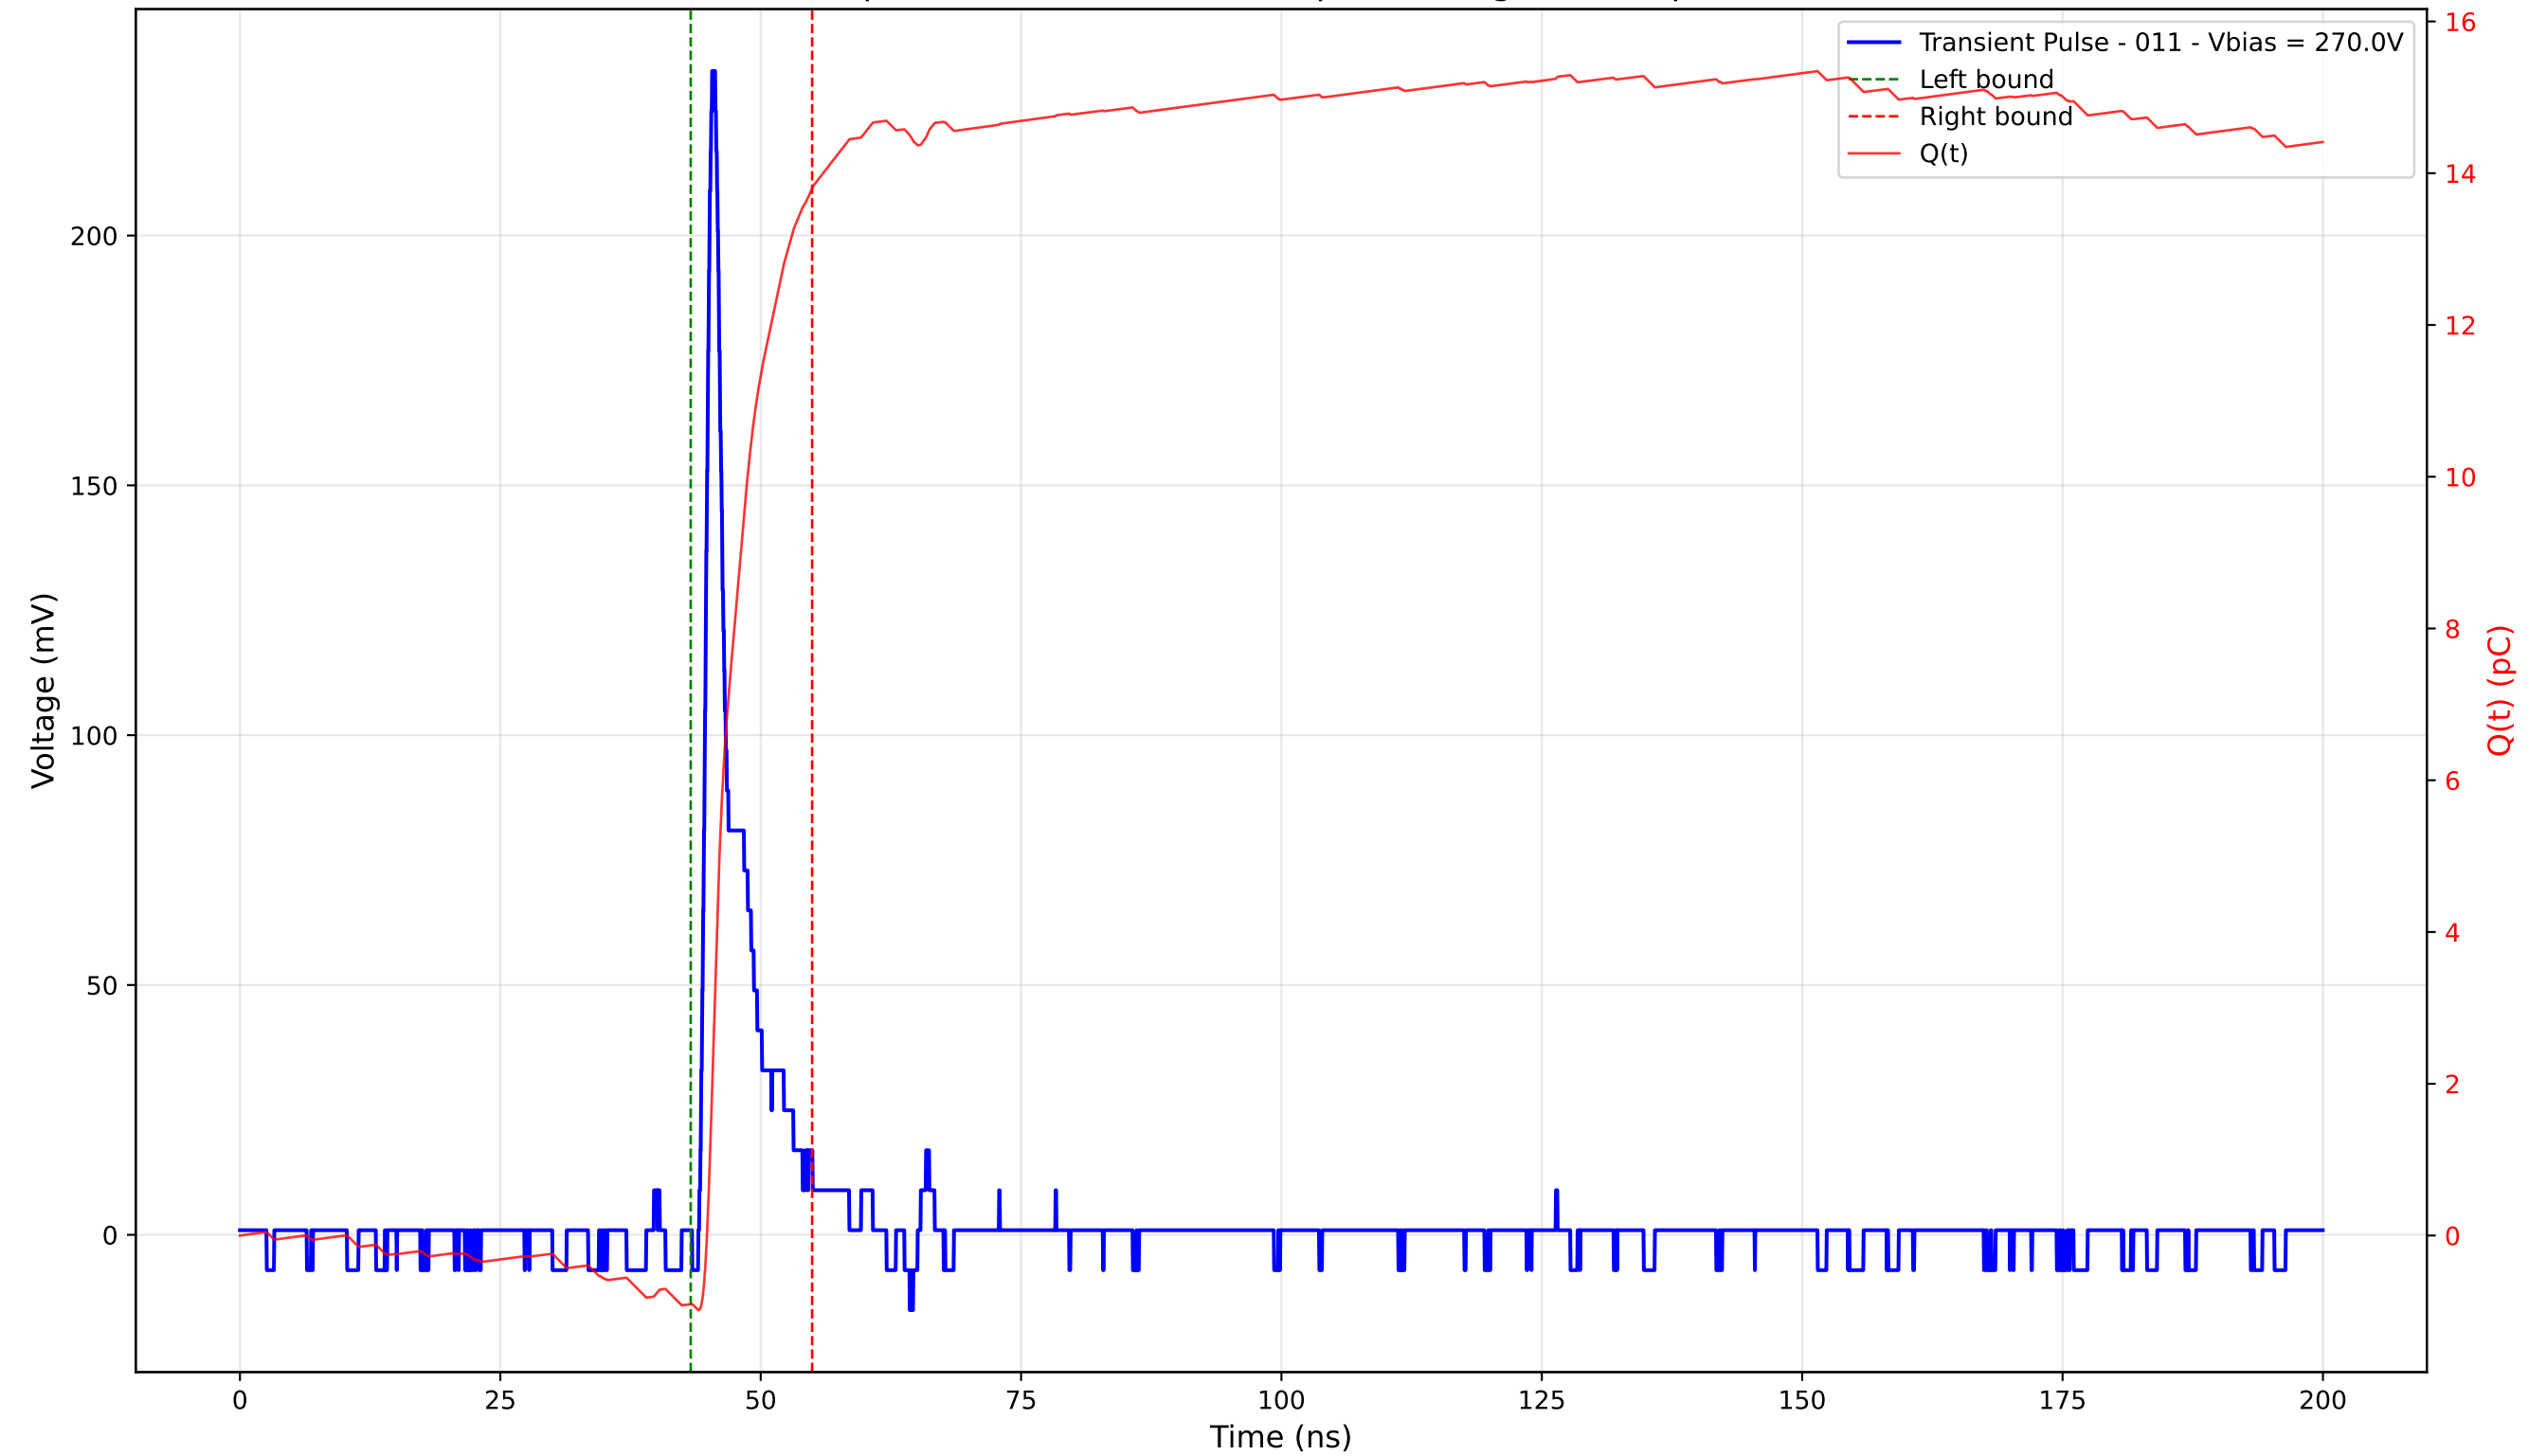


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 20.27 pC - Rise Time: 0.91 ns

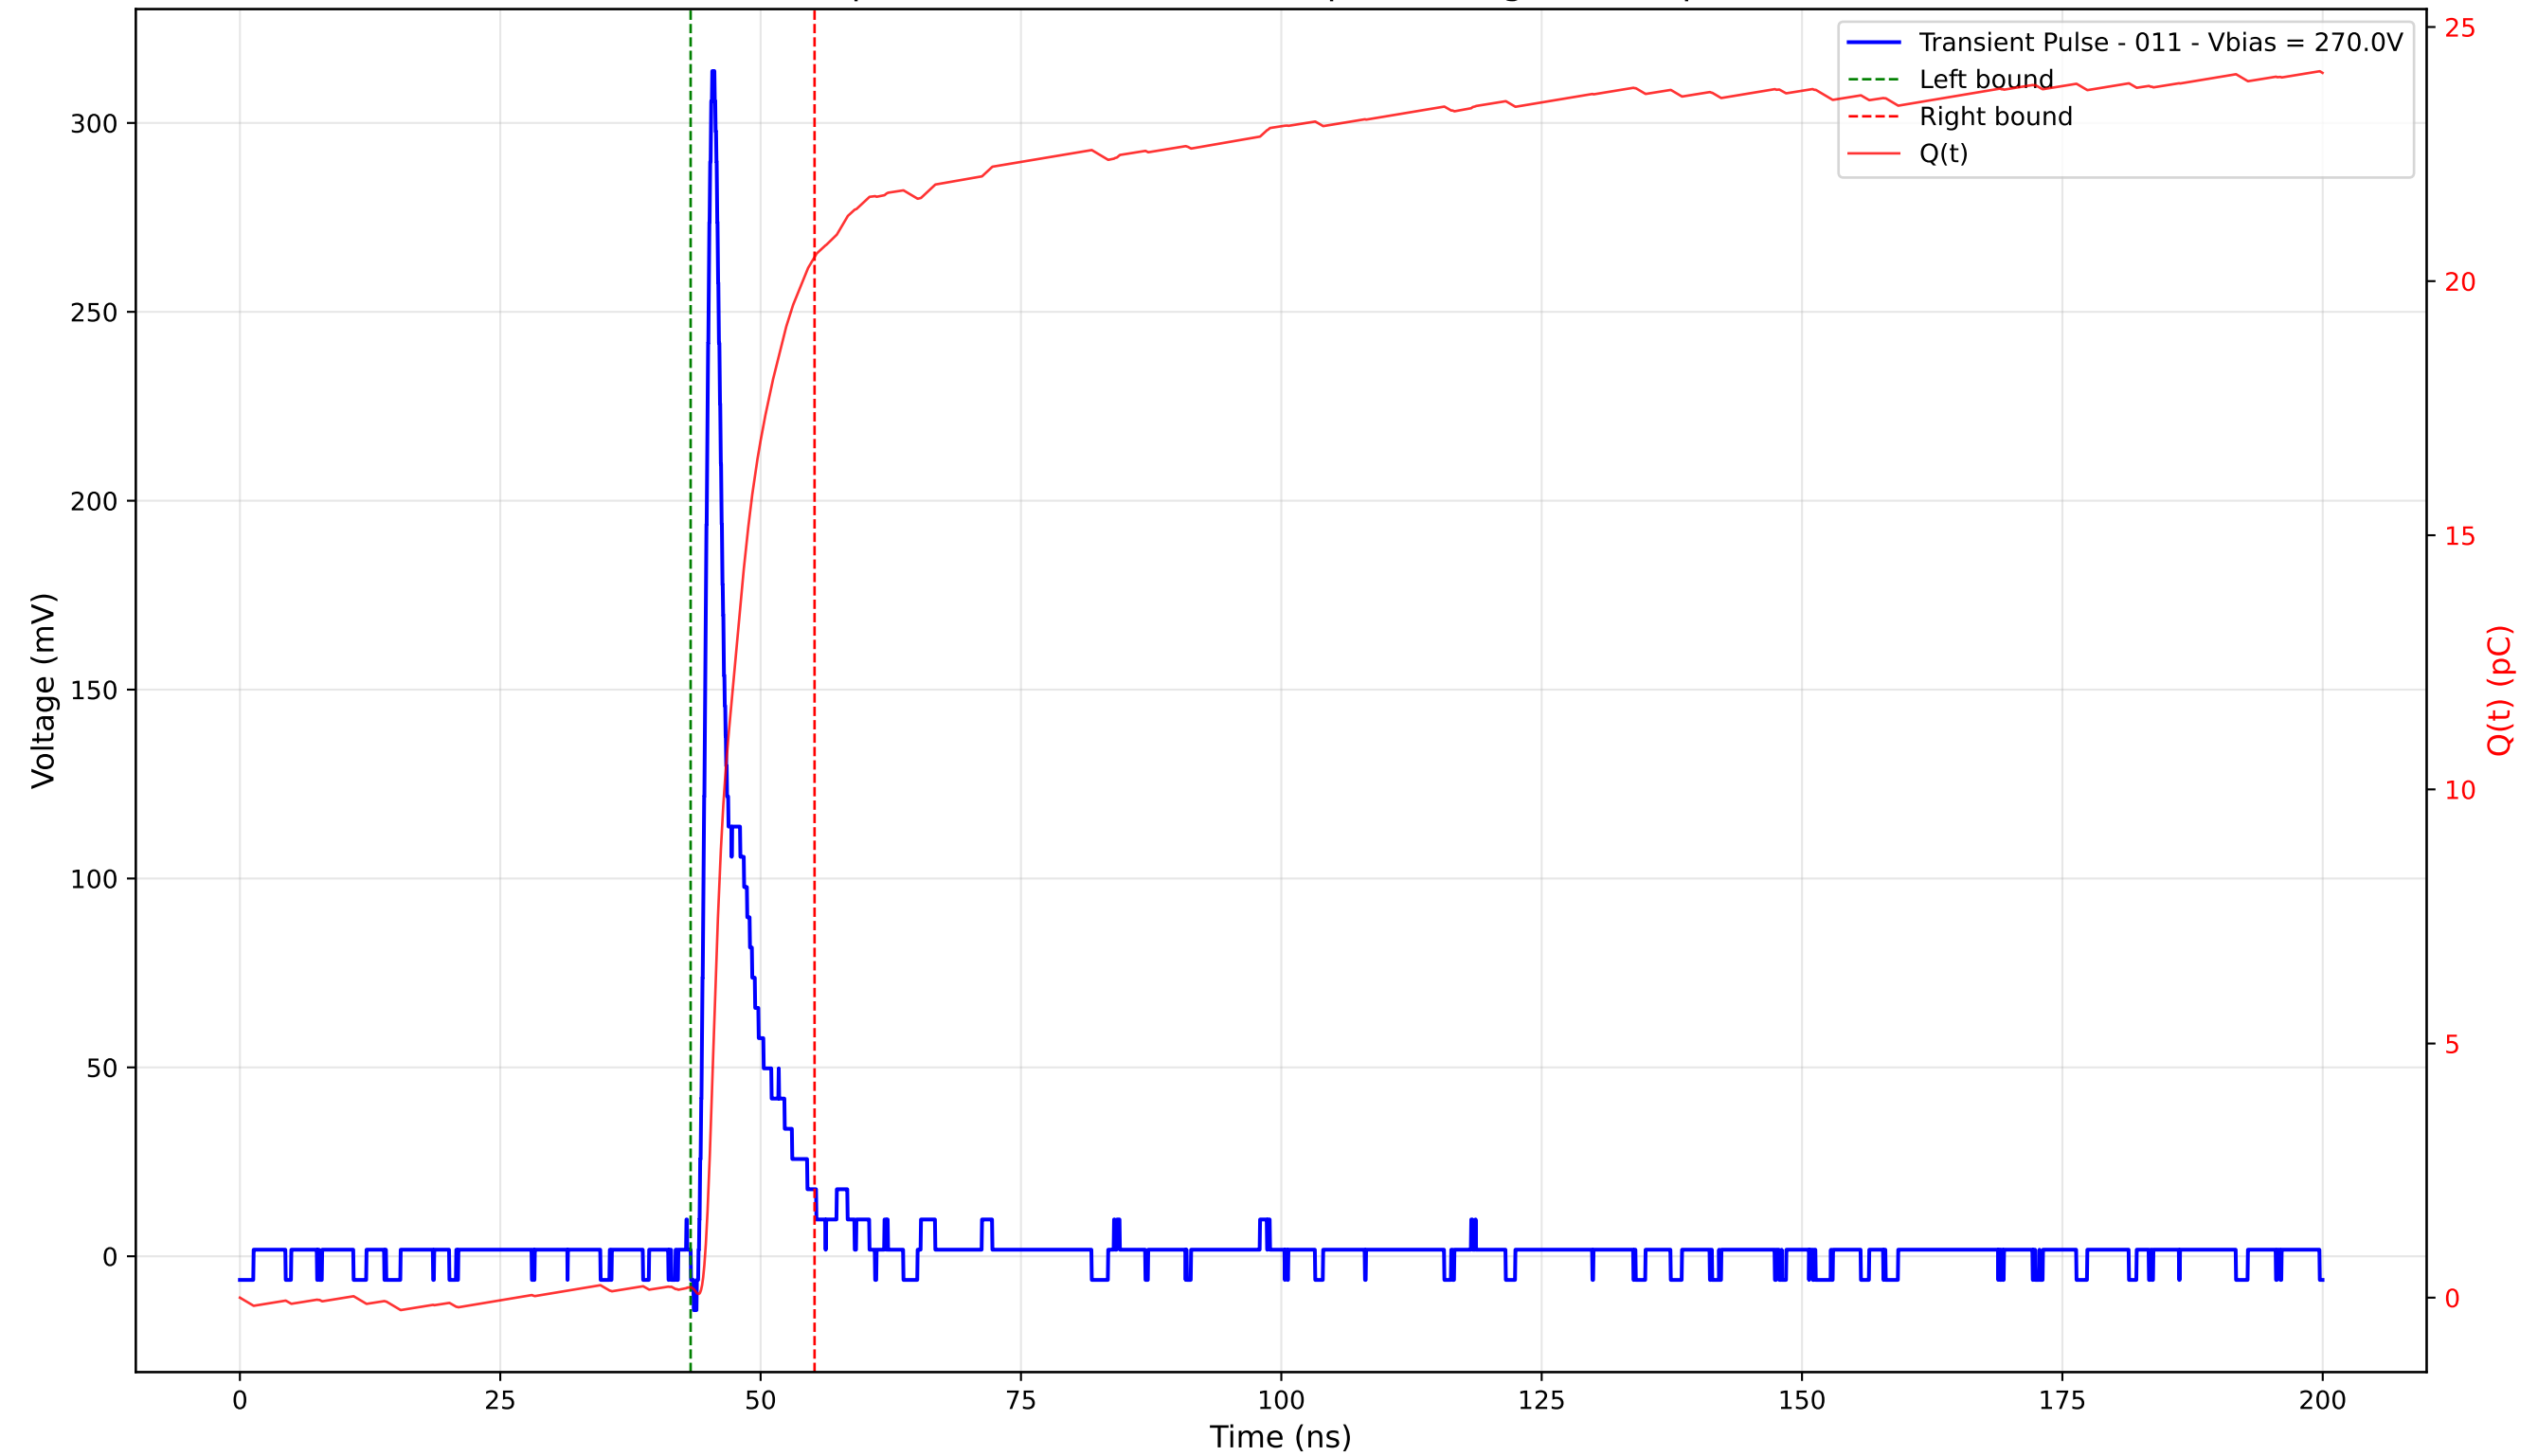


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 24.72 pC - Rise Time: 0.89 ns

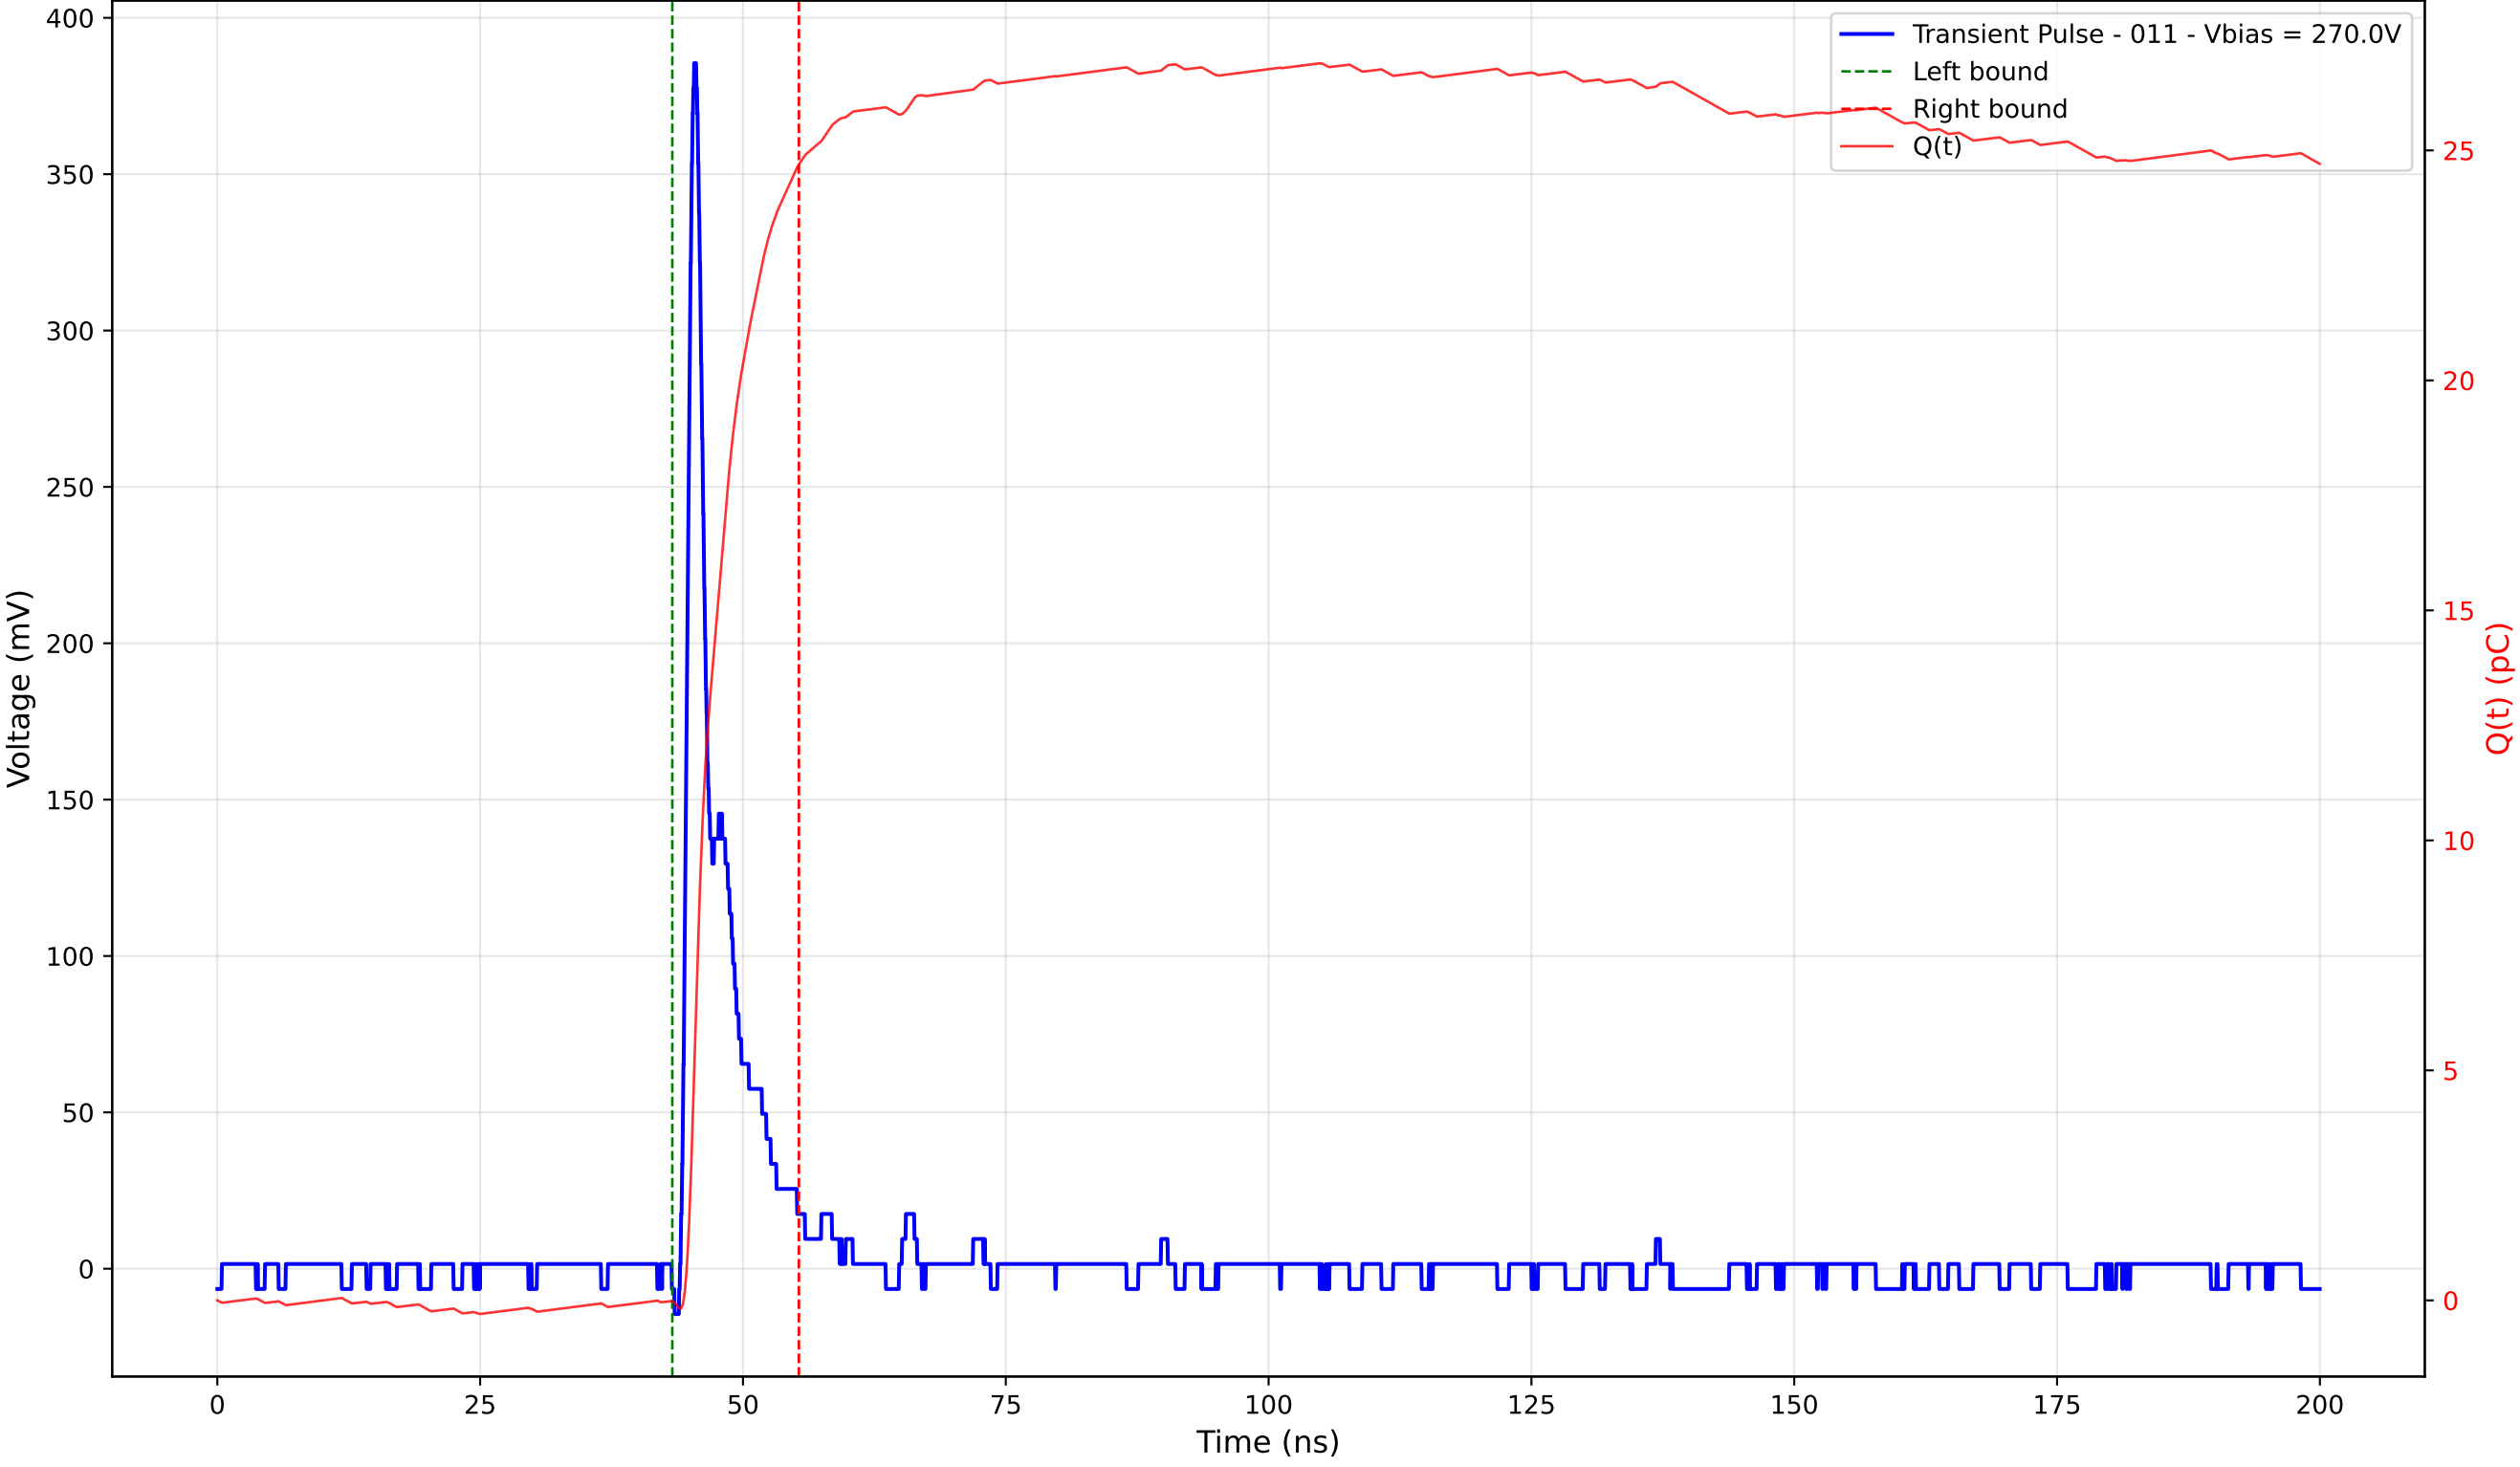


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 30.26 pC - Rise Time: 0.91 ns

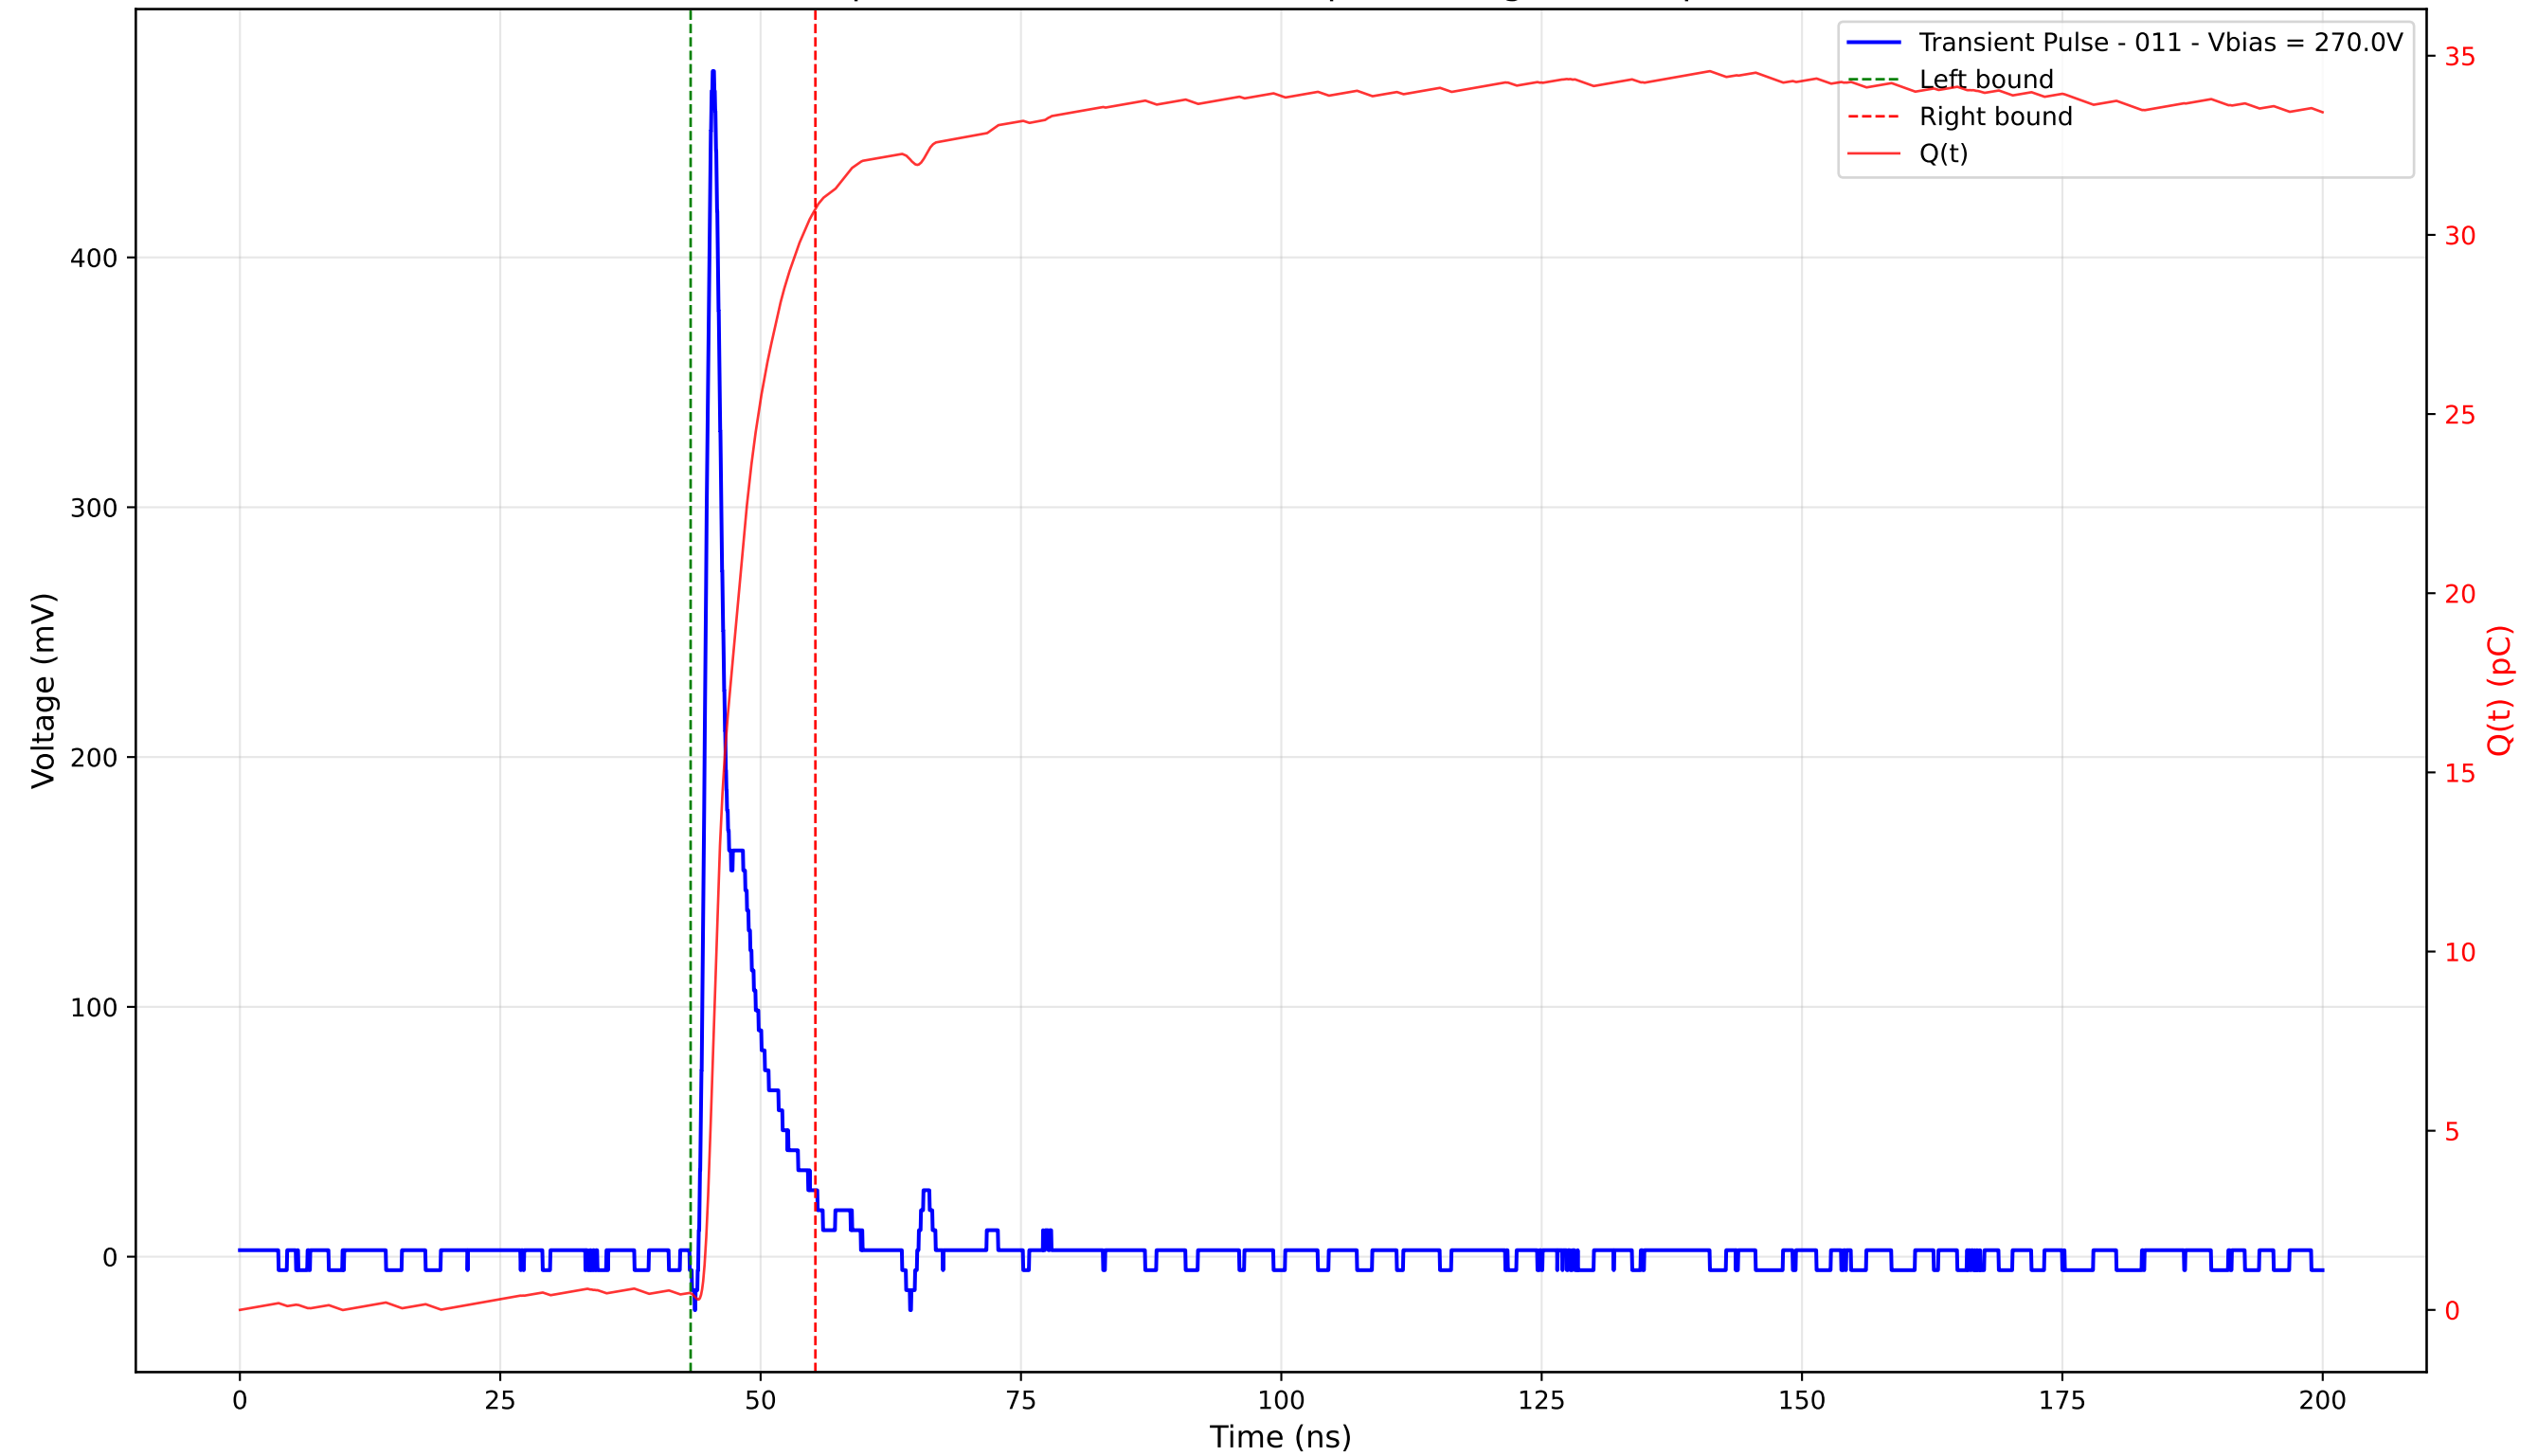


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 33.30 pC - Rise Time: 0.91 ns

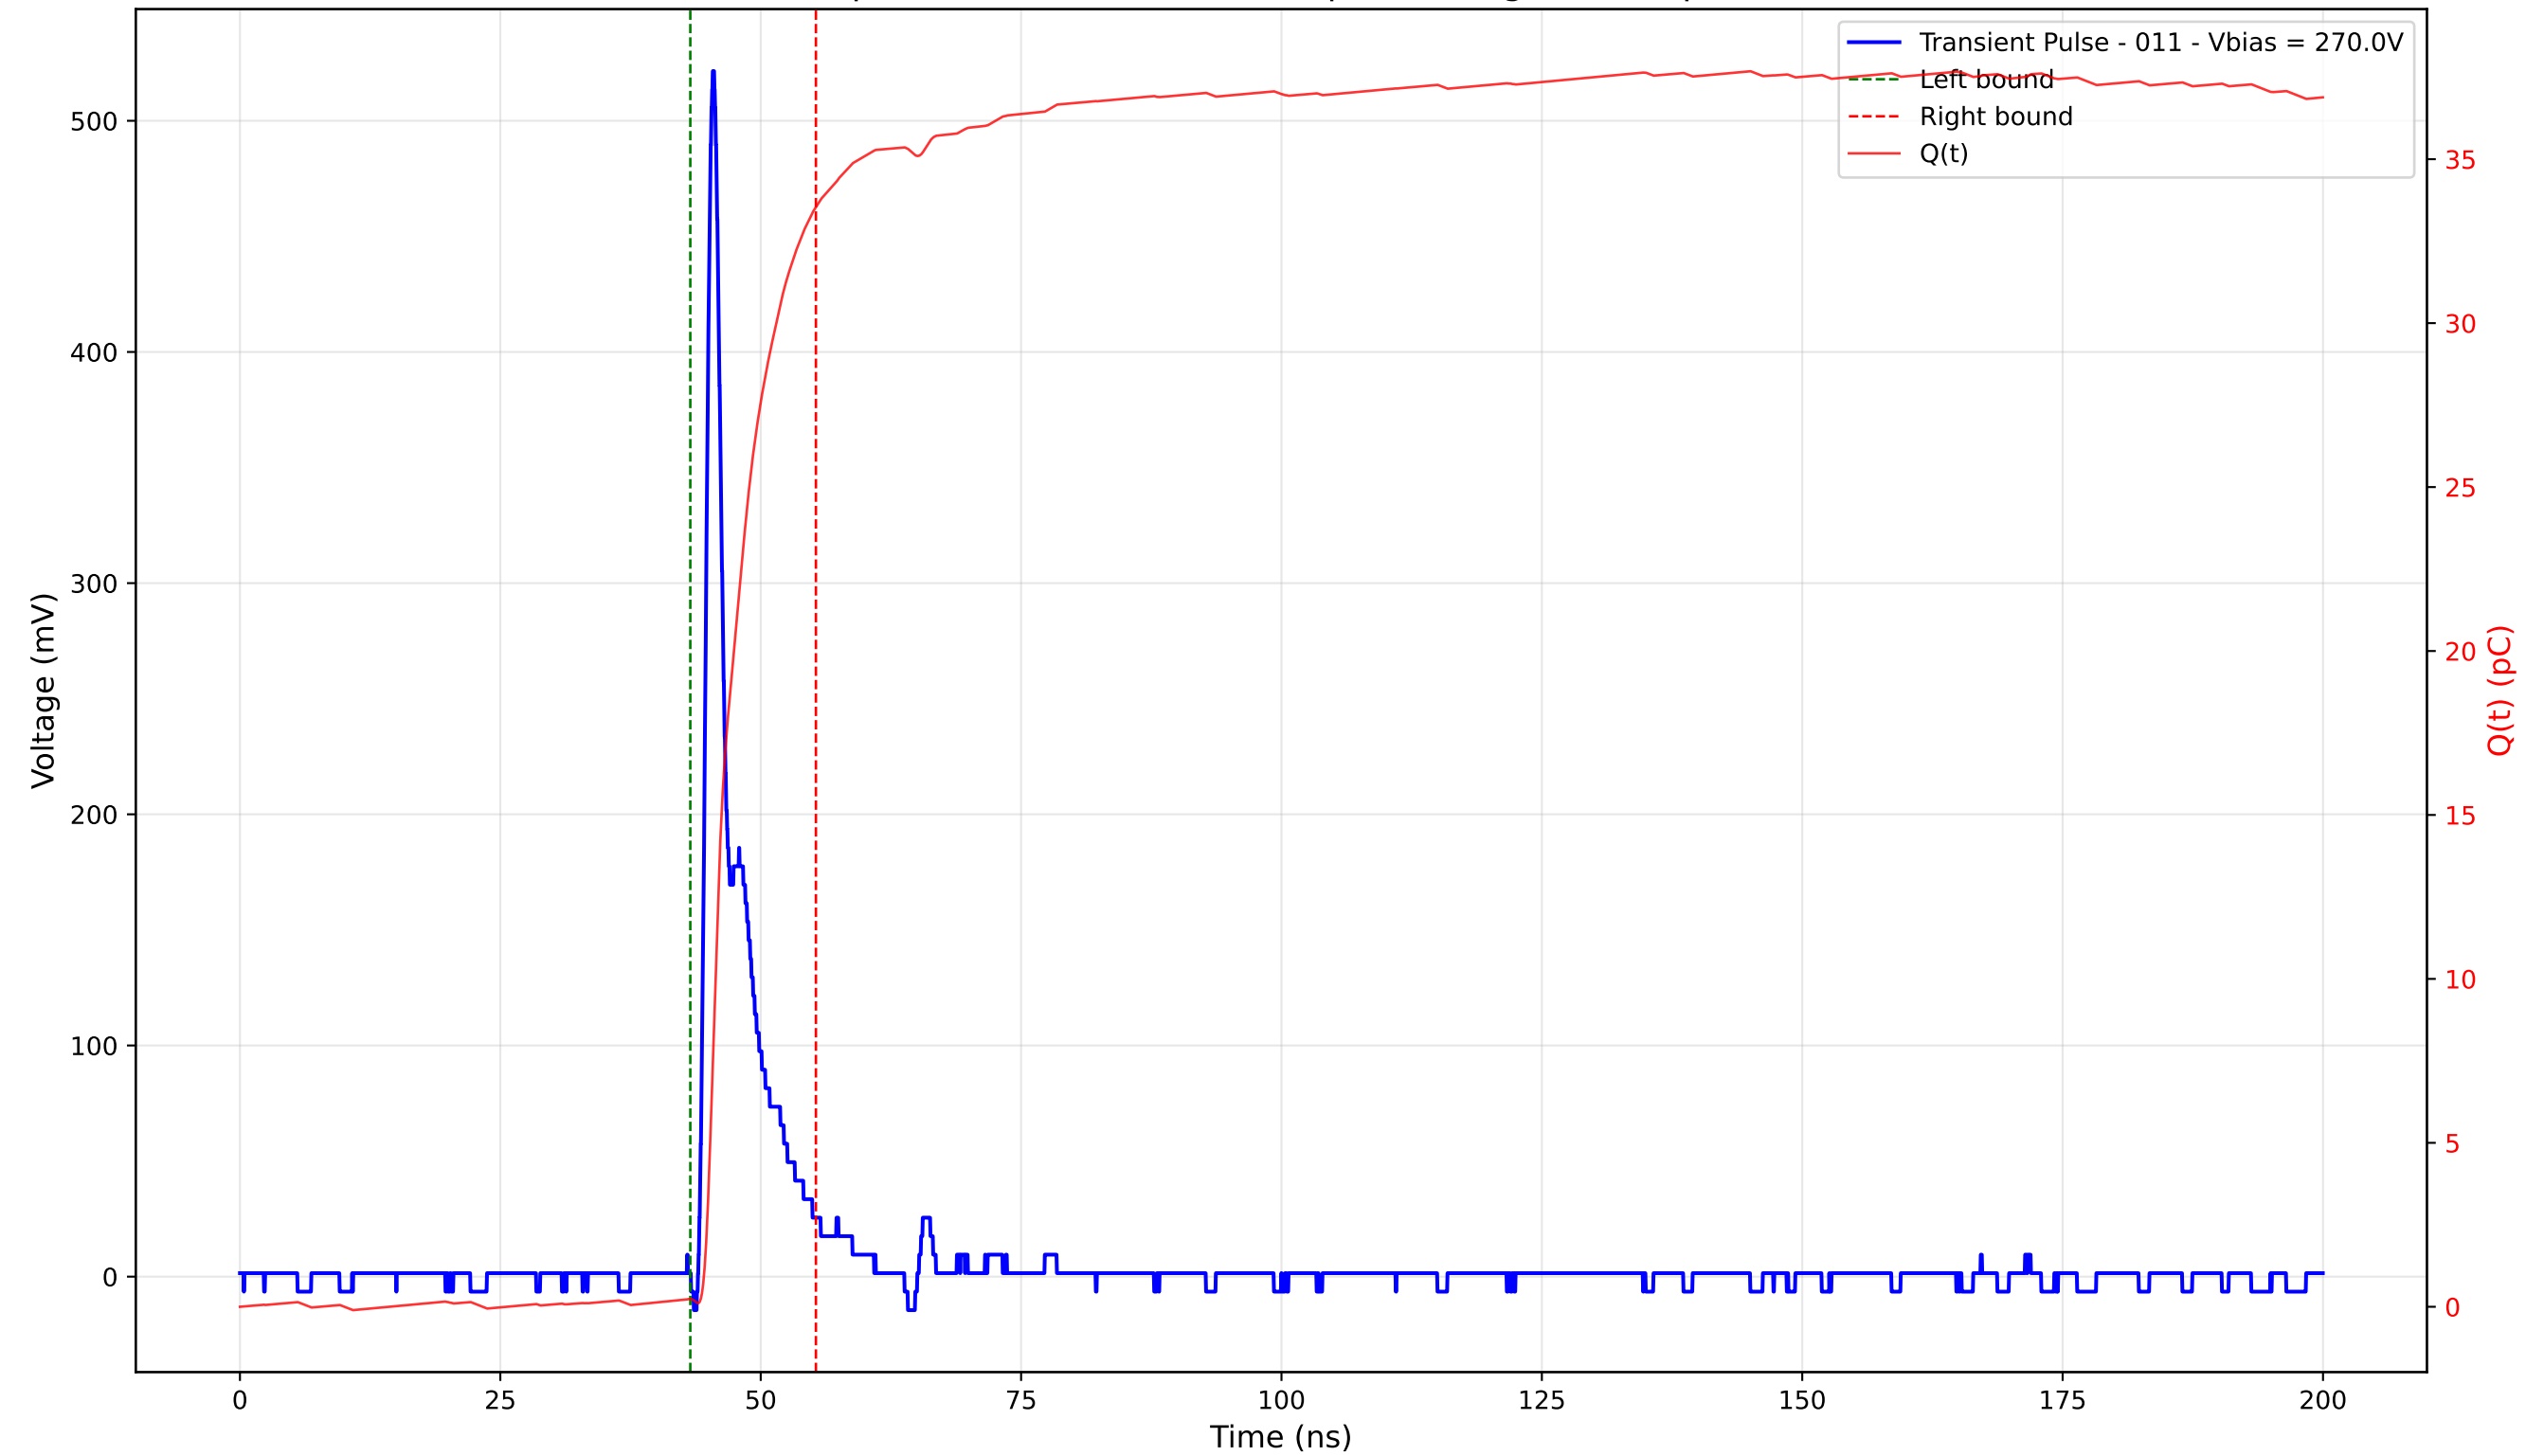


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 35.22 pC - Rise Time: 0.89 ns

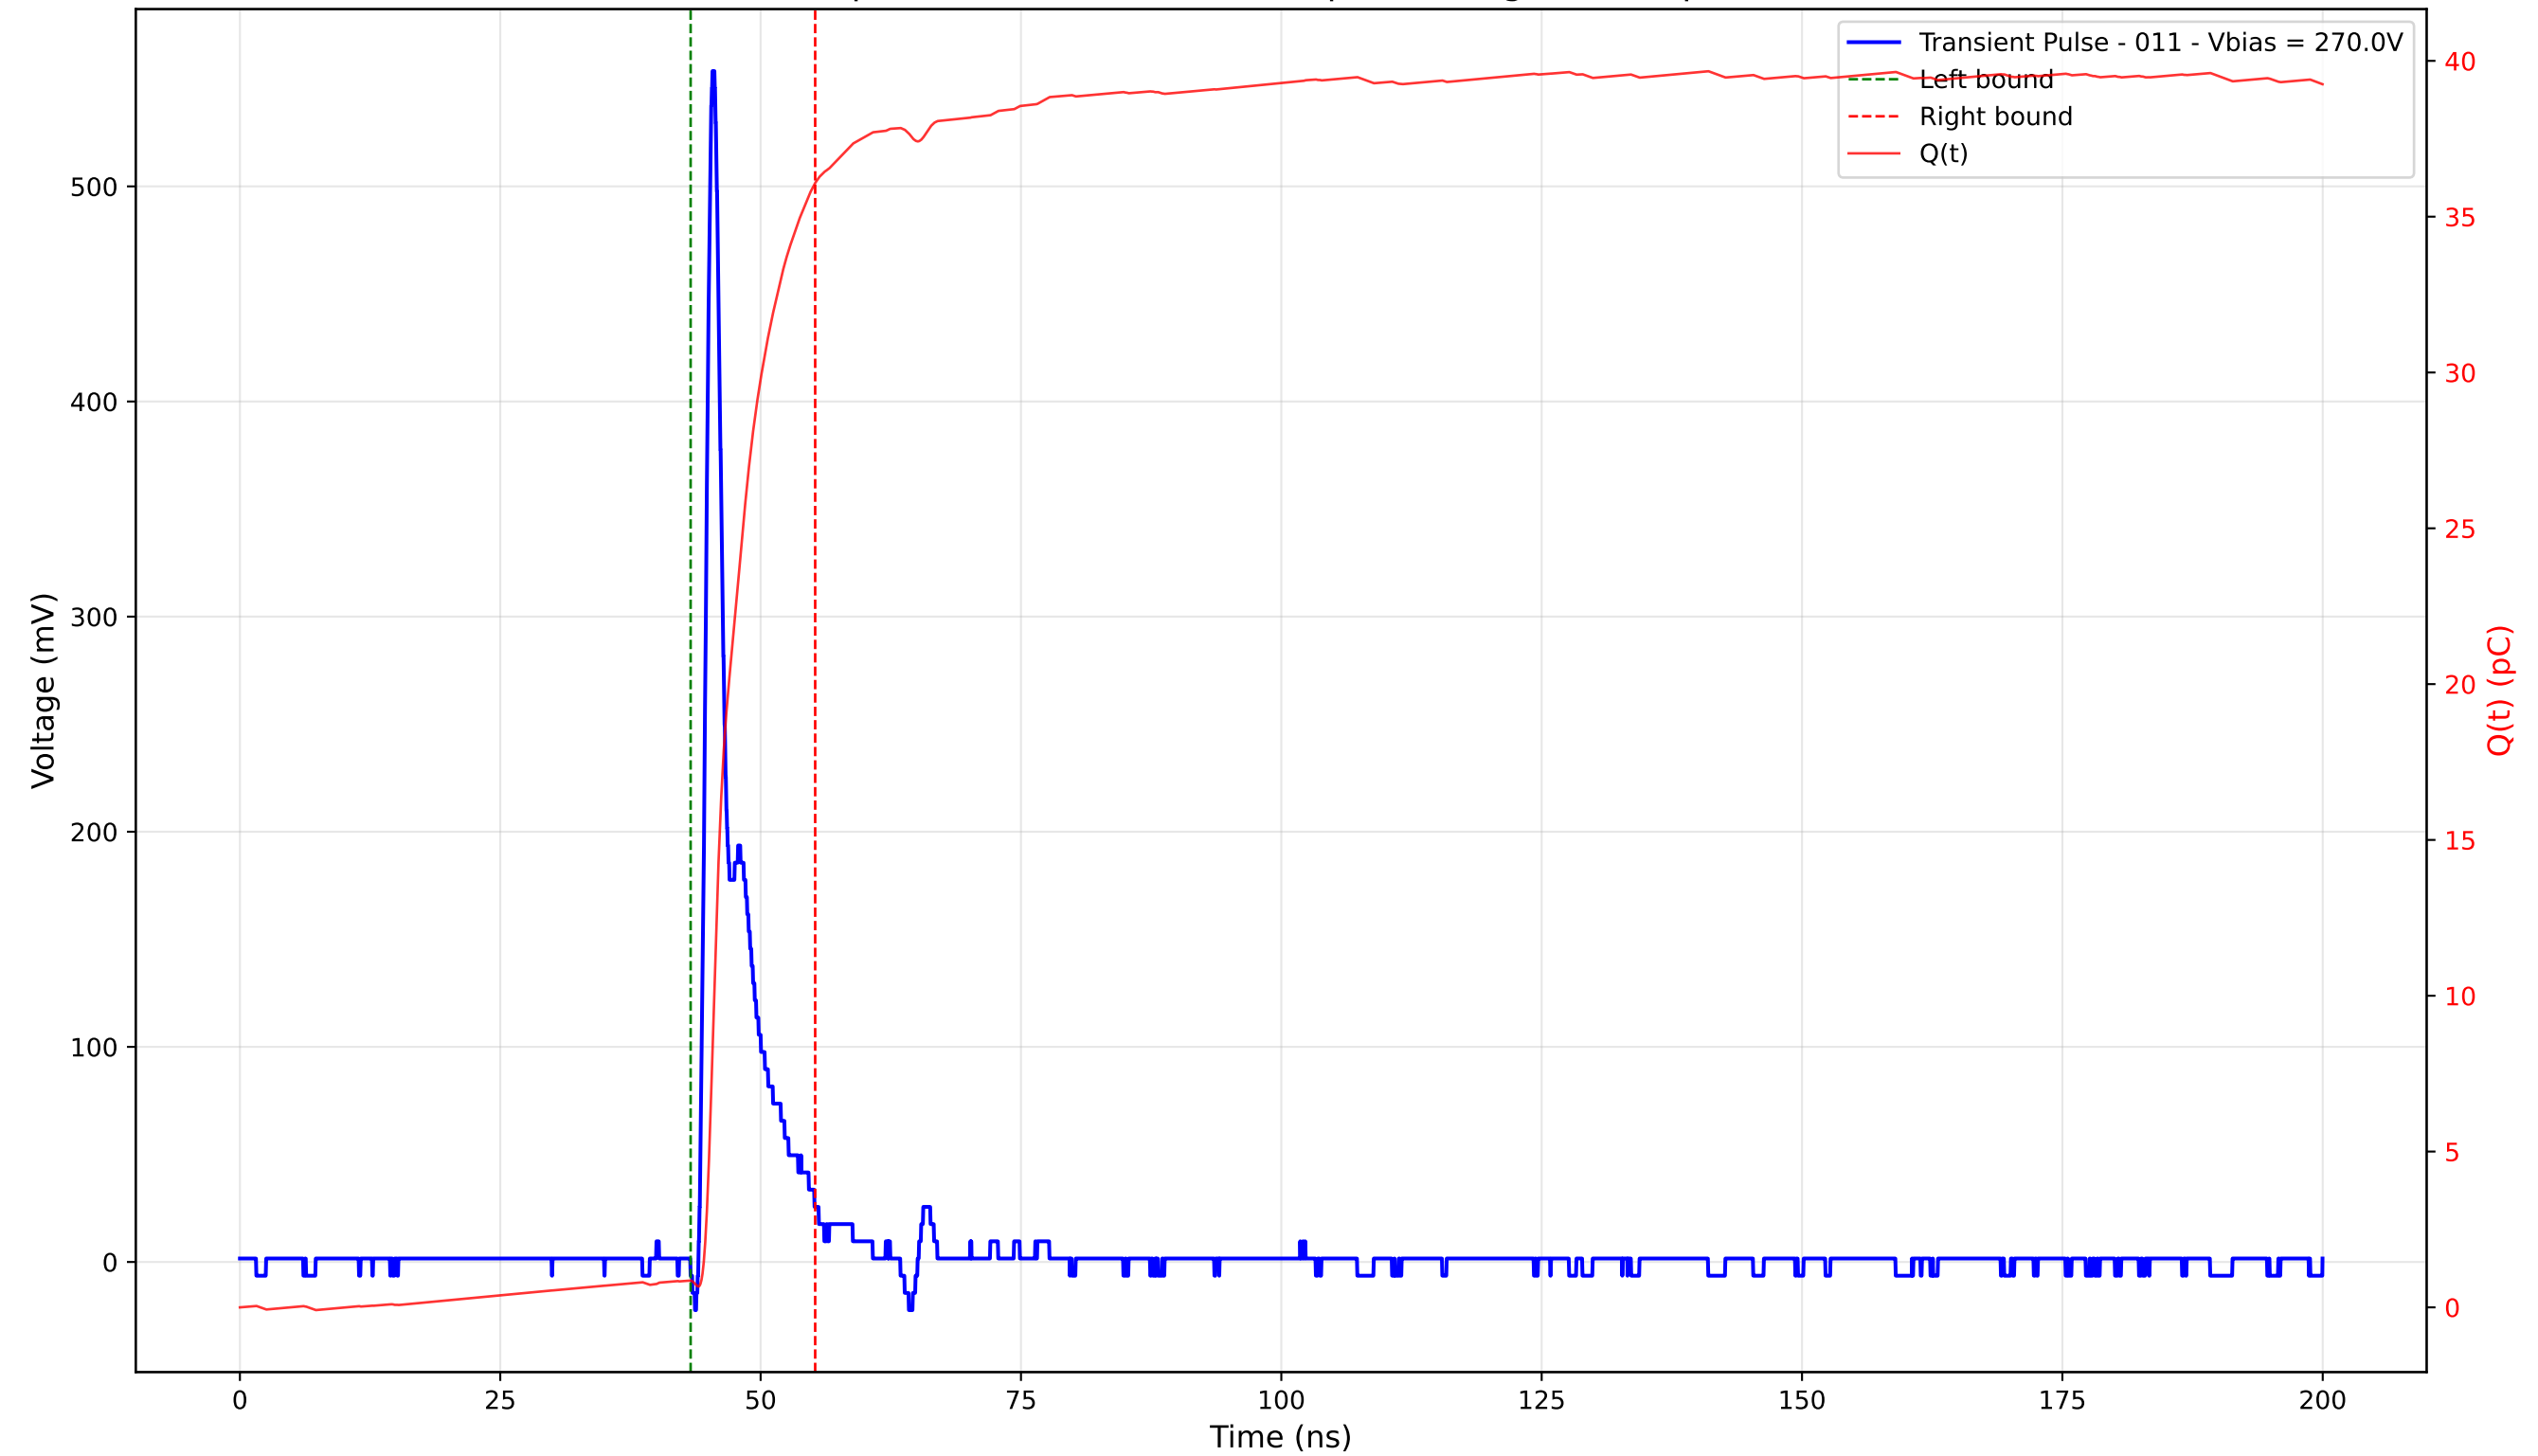


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 35.99 pC - Rise Time: 0.89 ns

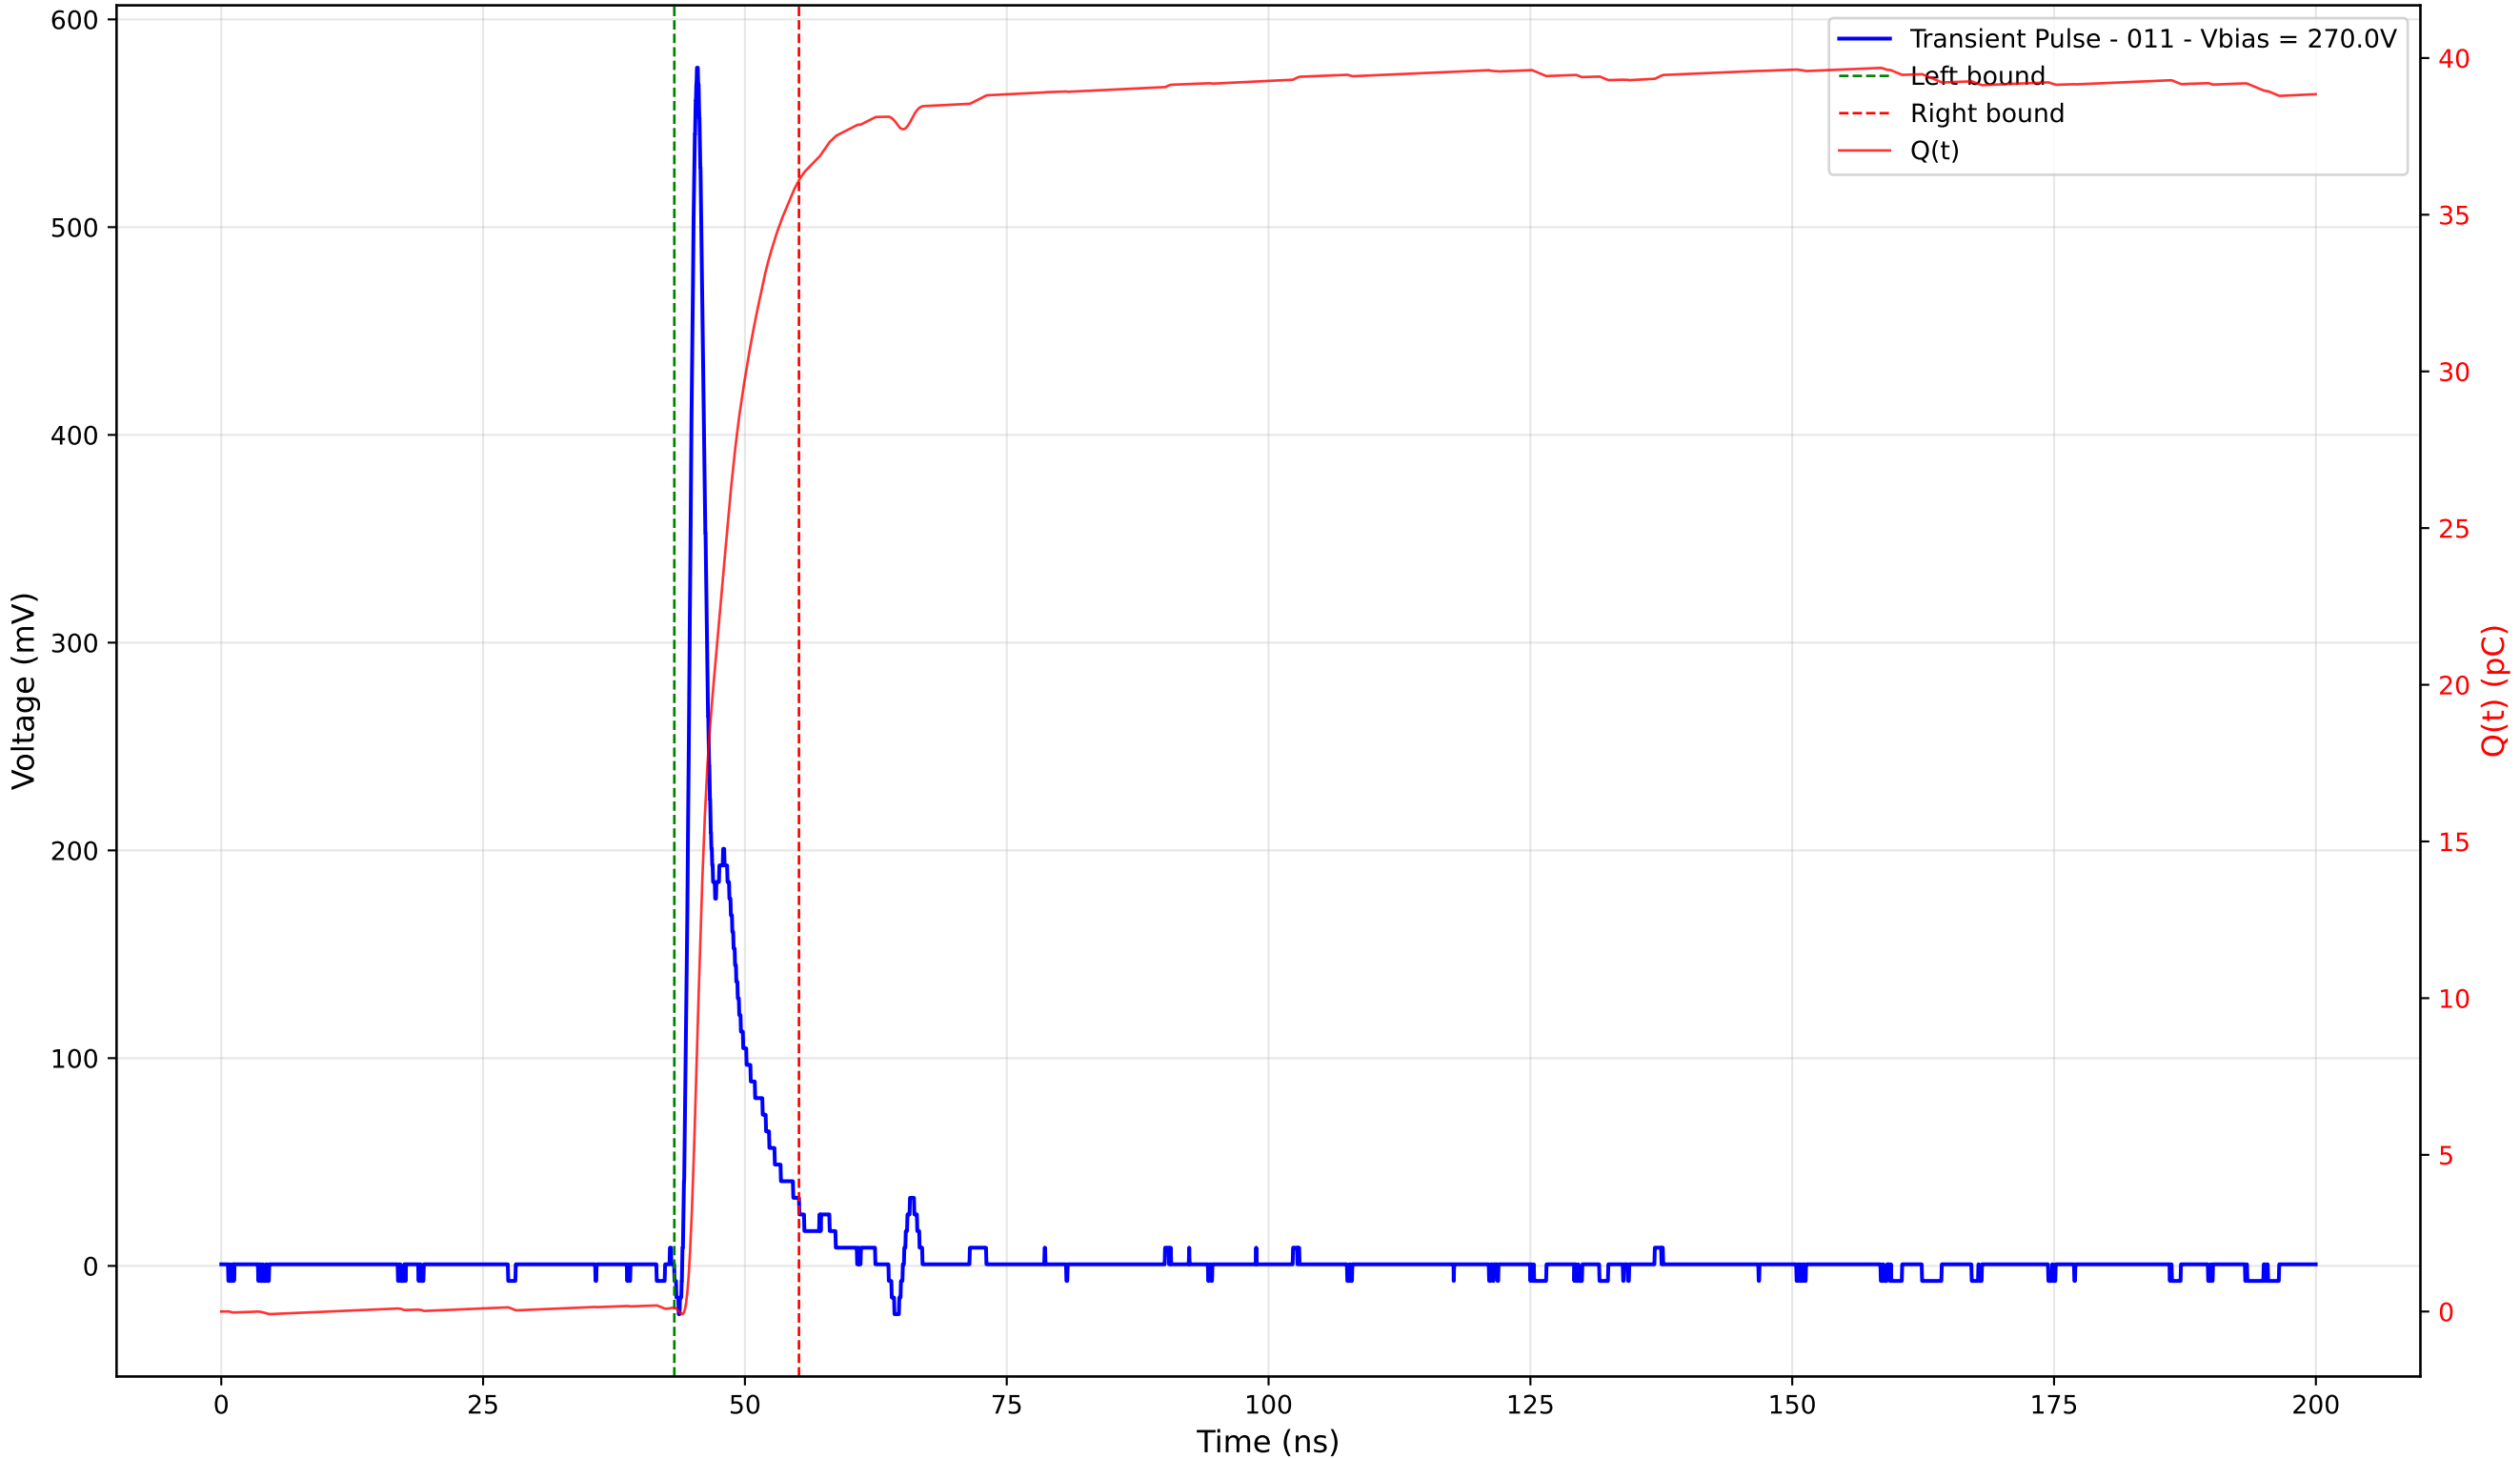


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 36.41 pC - Rise Time: 0.89 ns

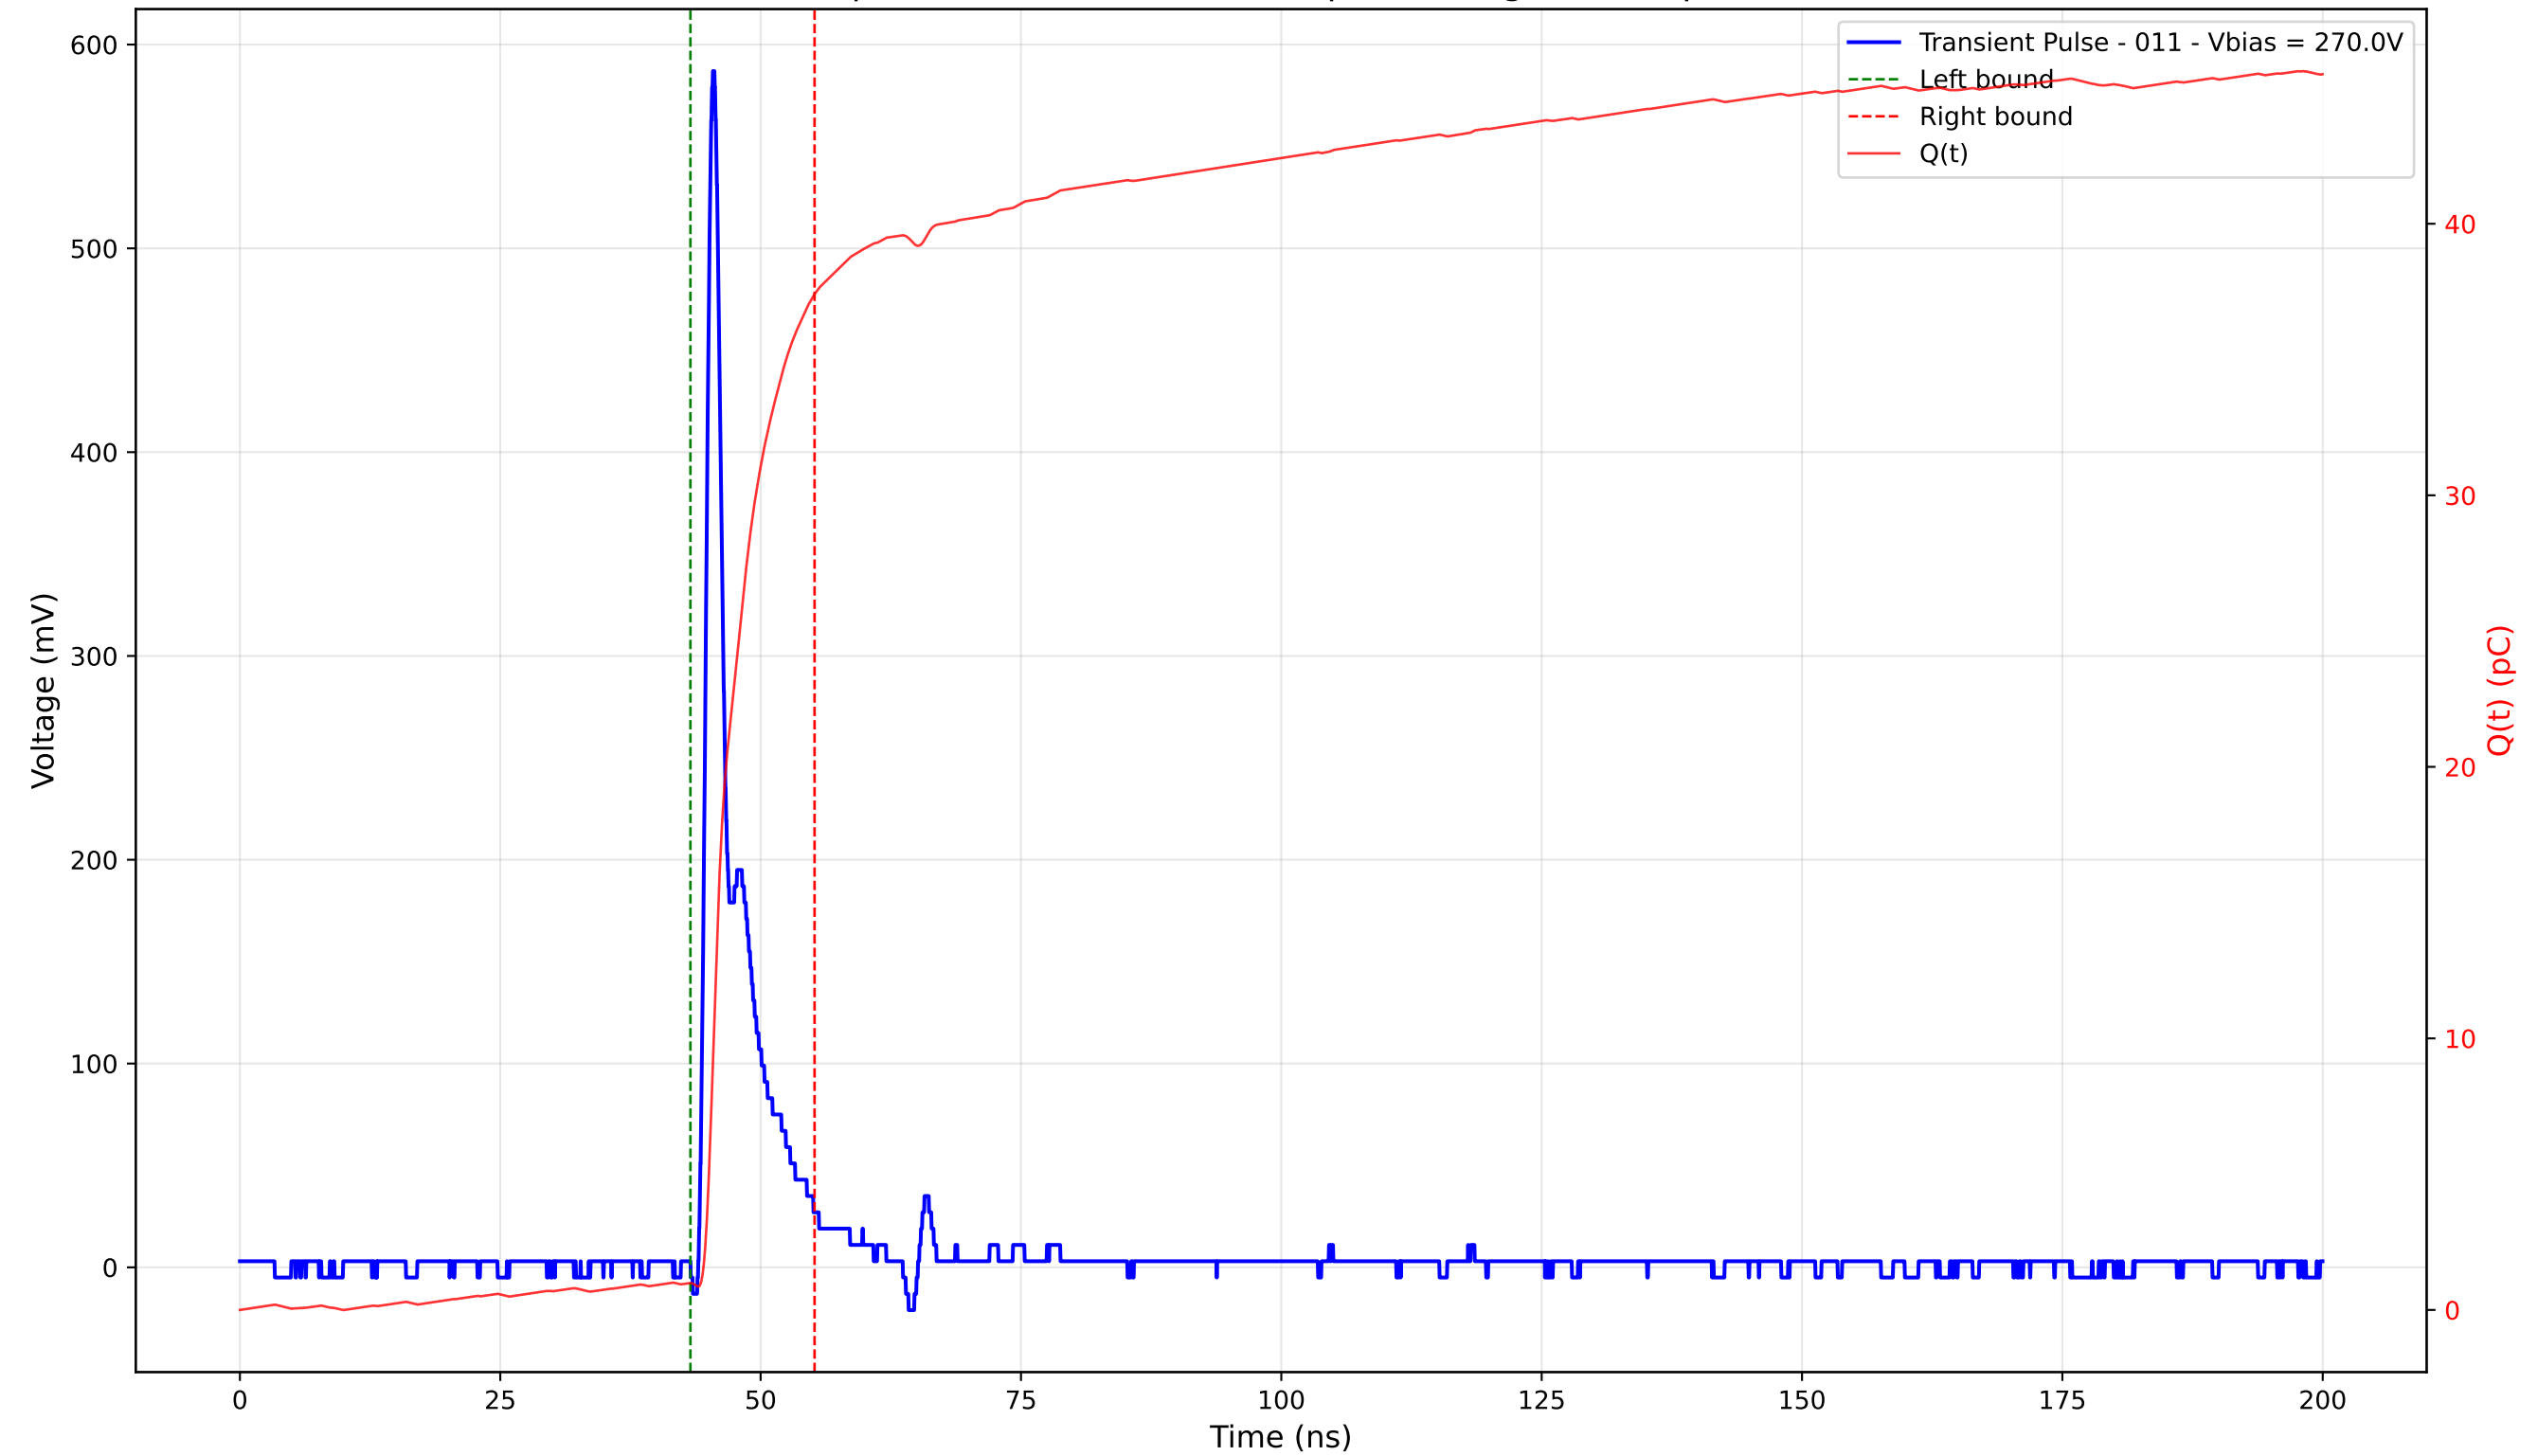


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 36.34 pC - Rise Time: 0.91 ns

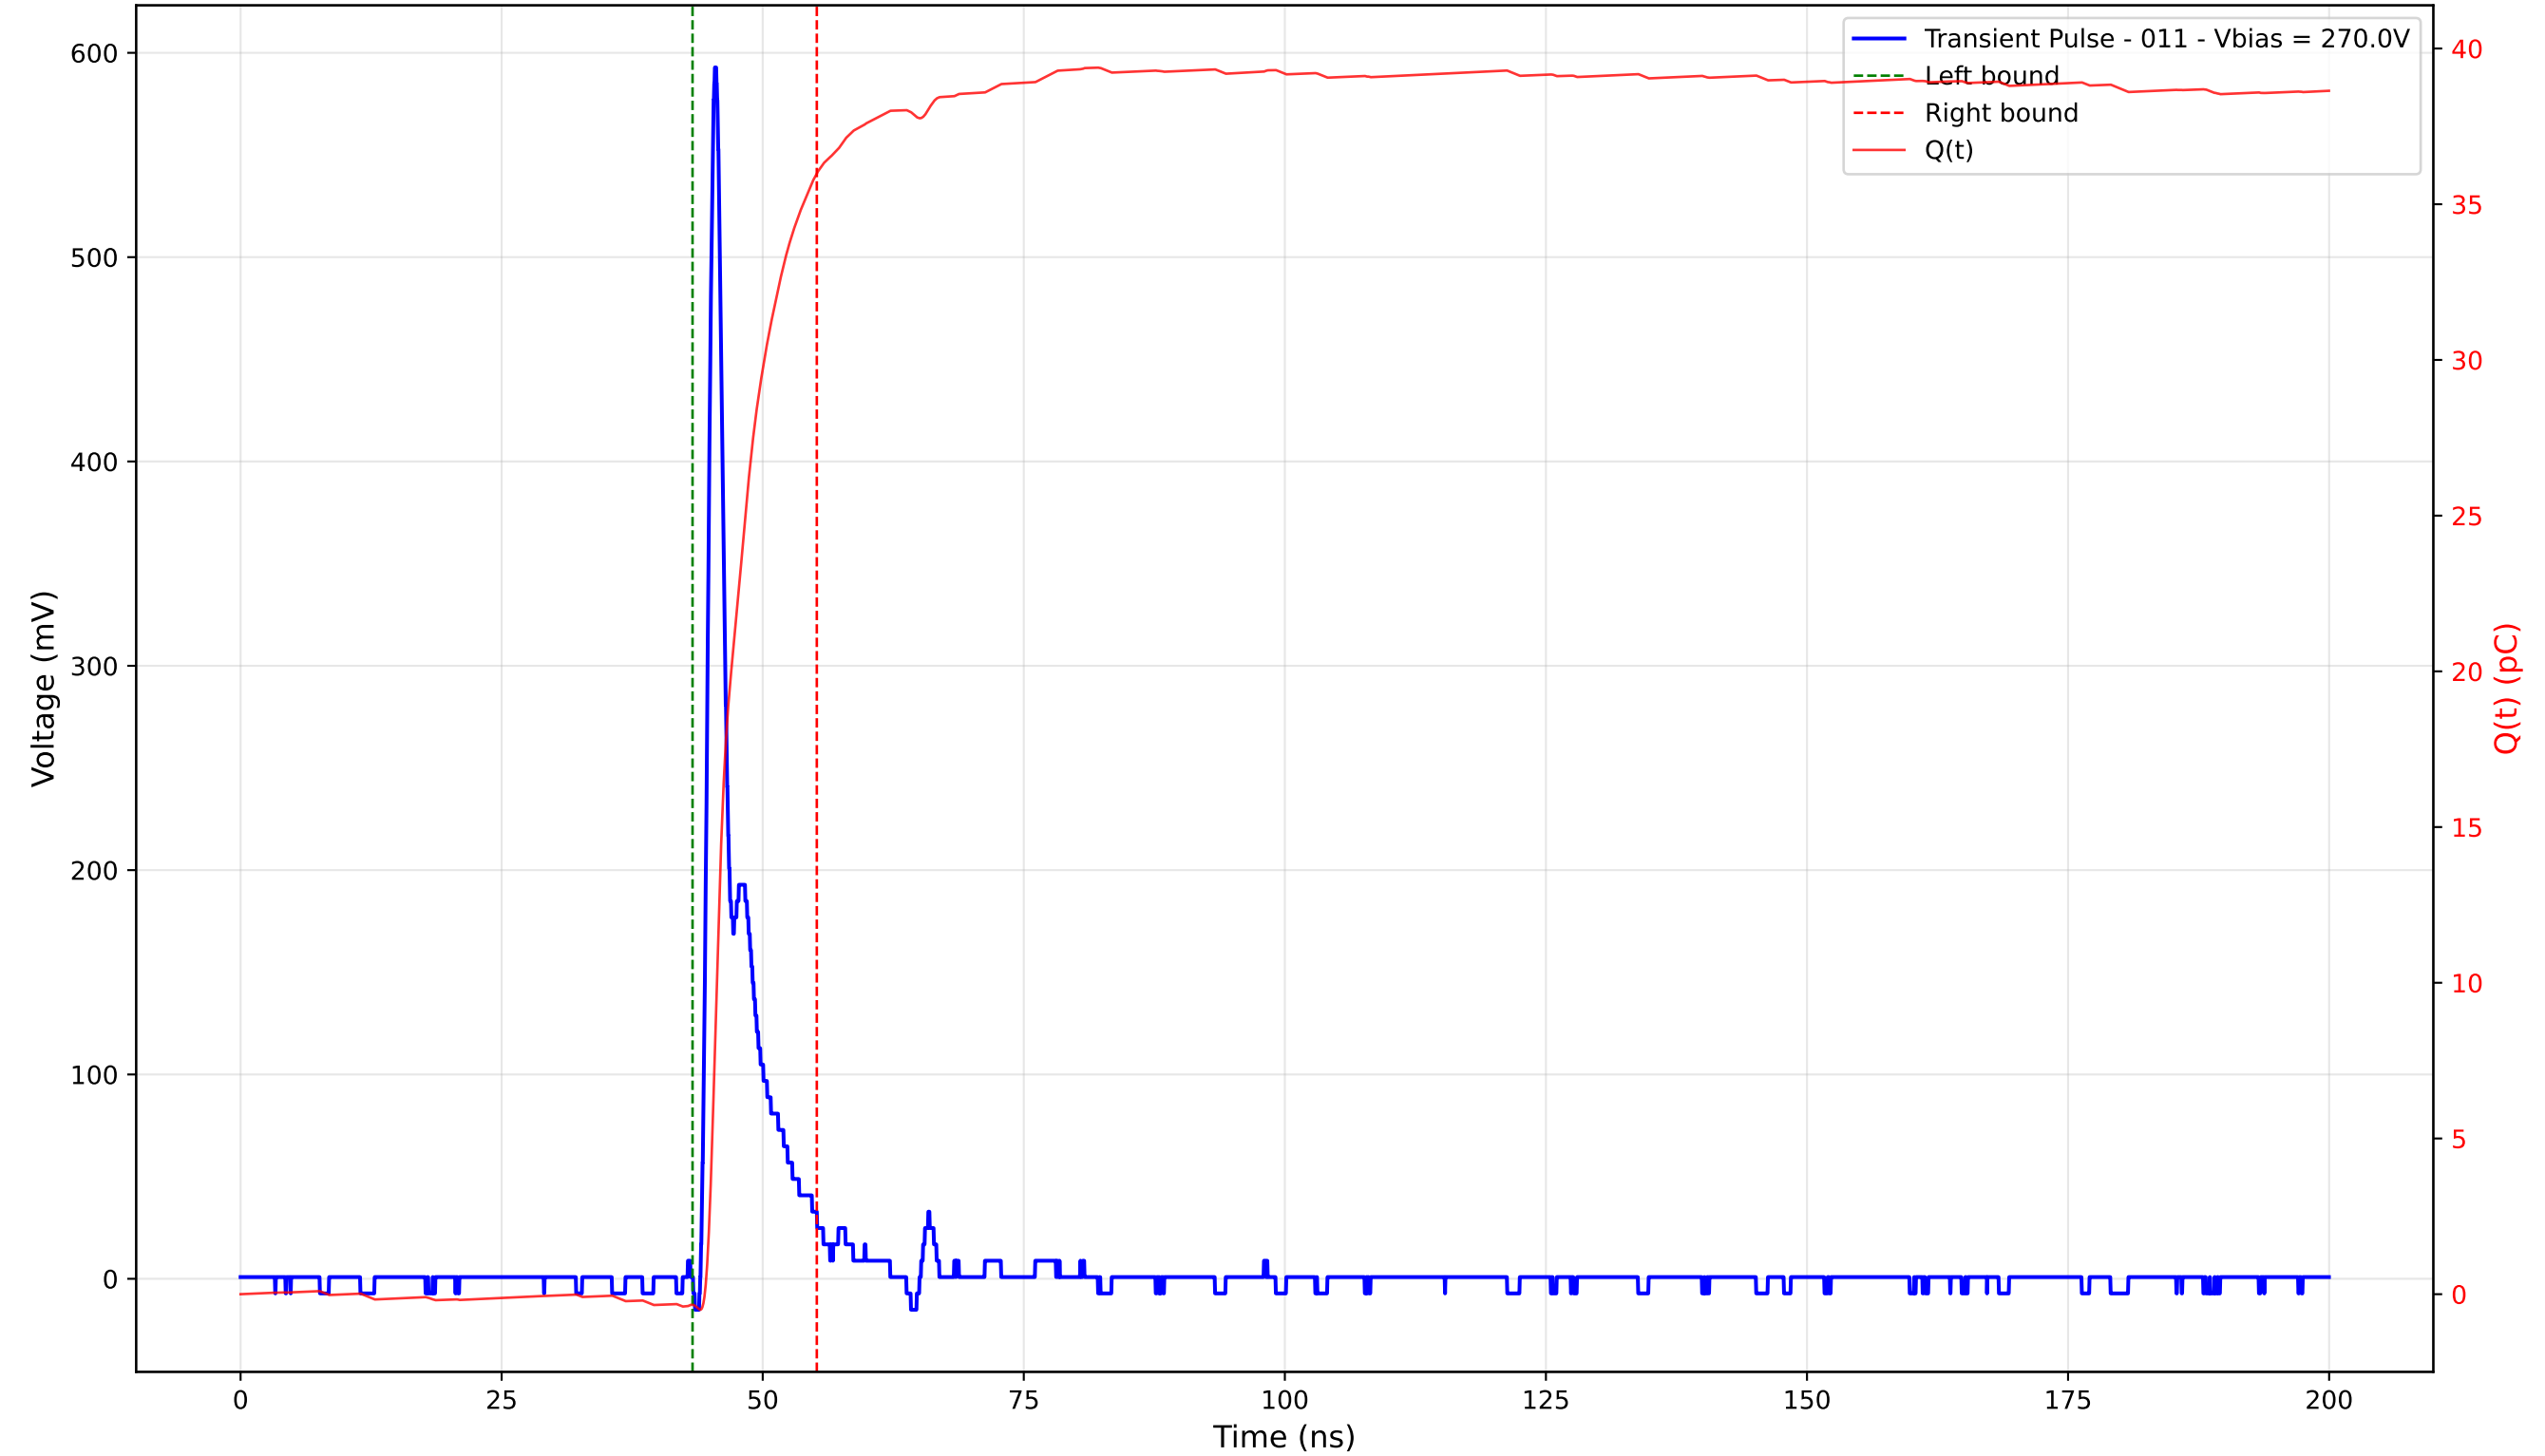


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 35.66 pC - Rise Time: 0.91 ns

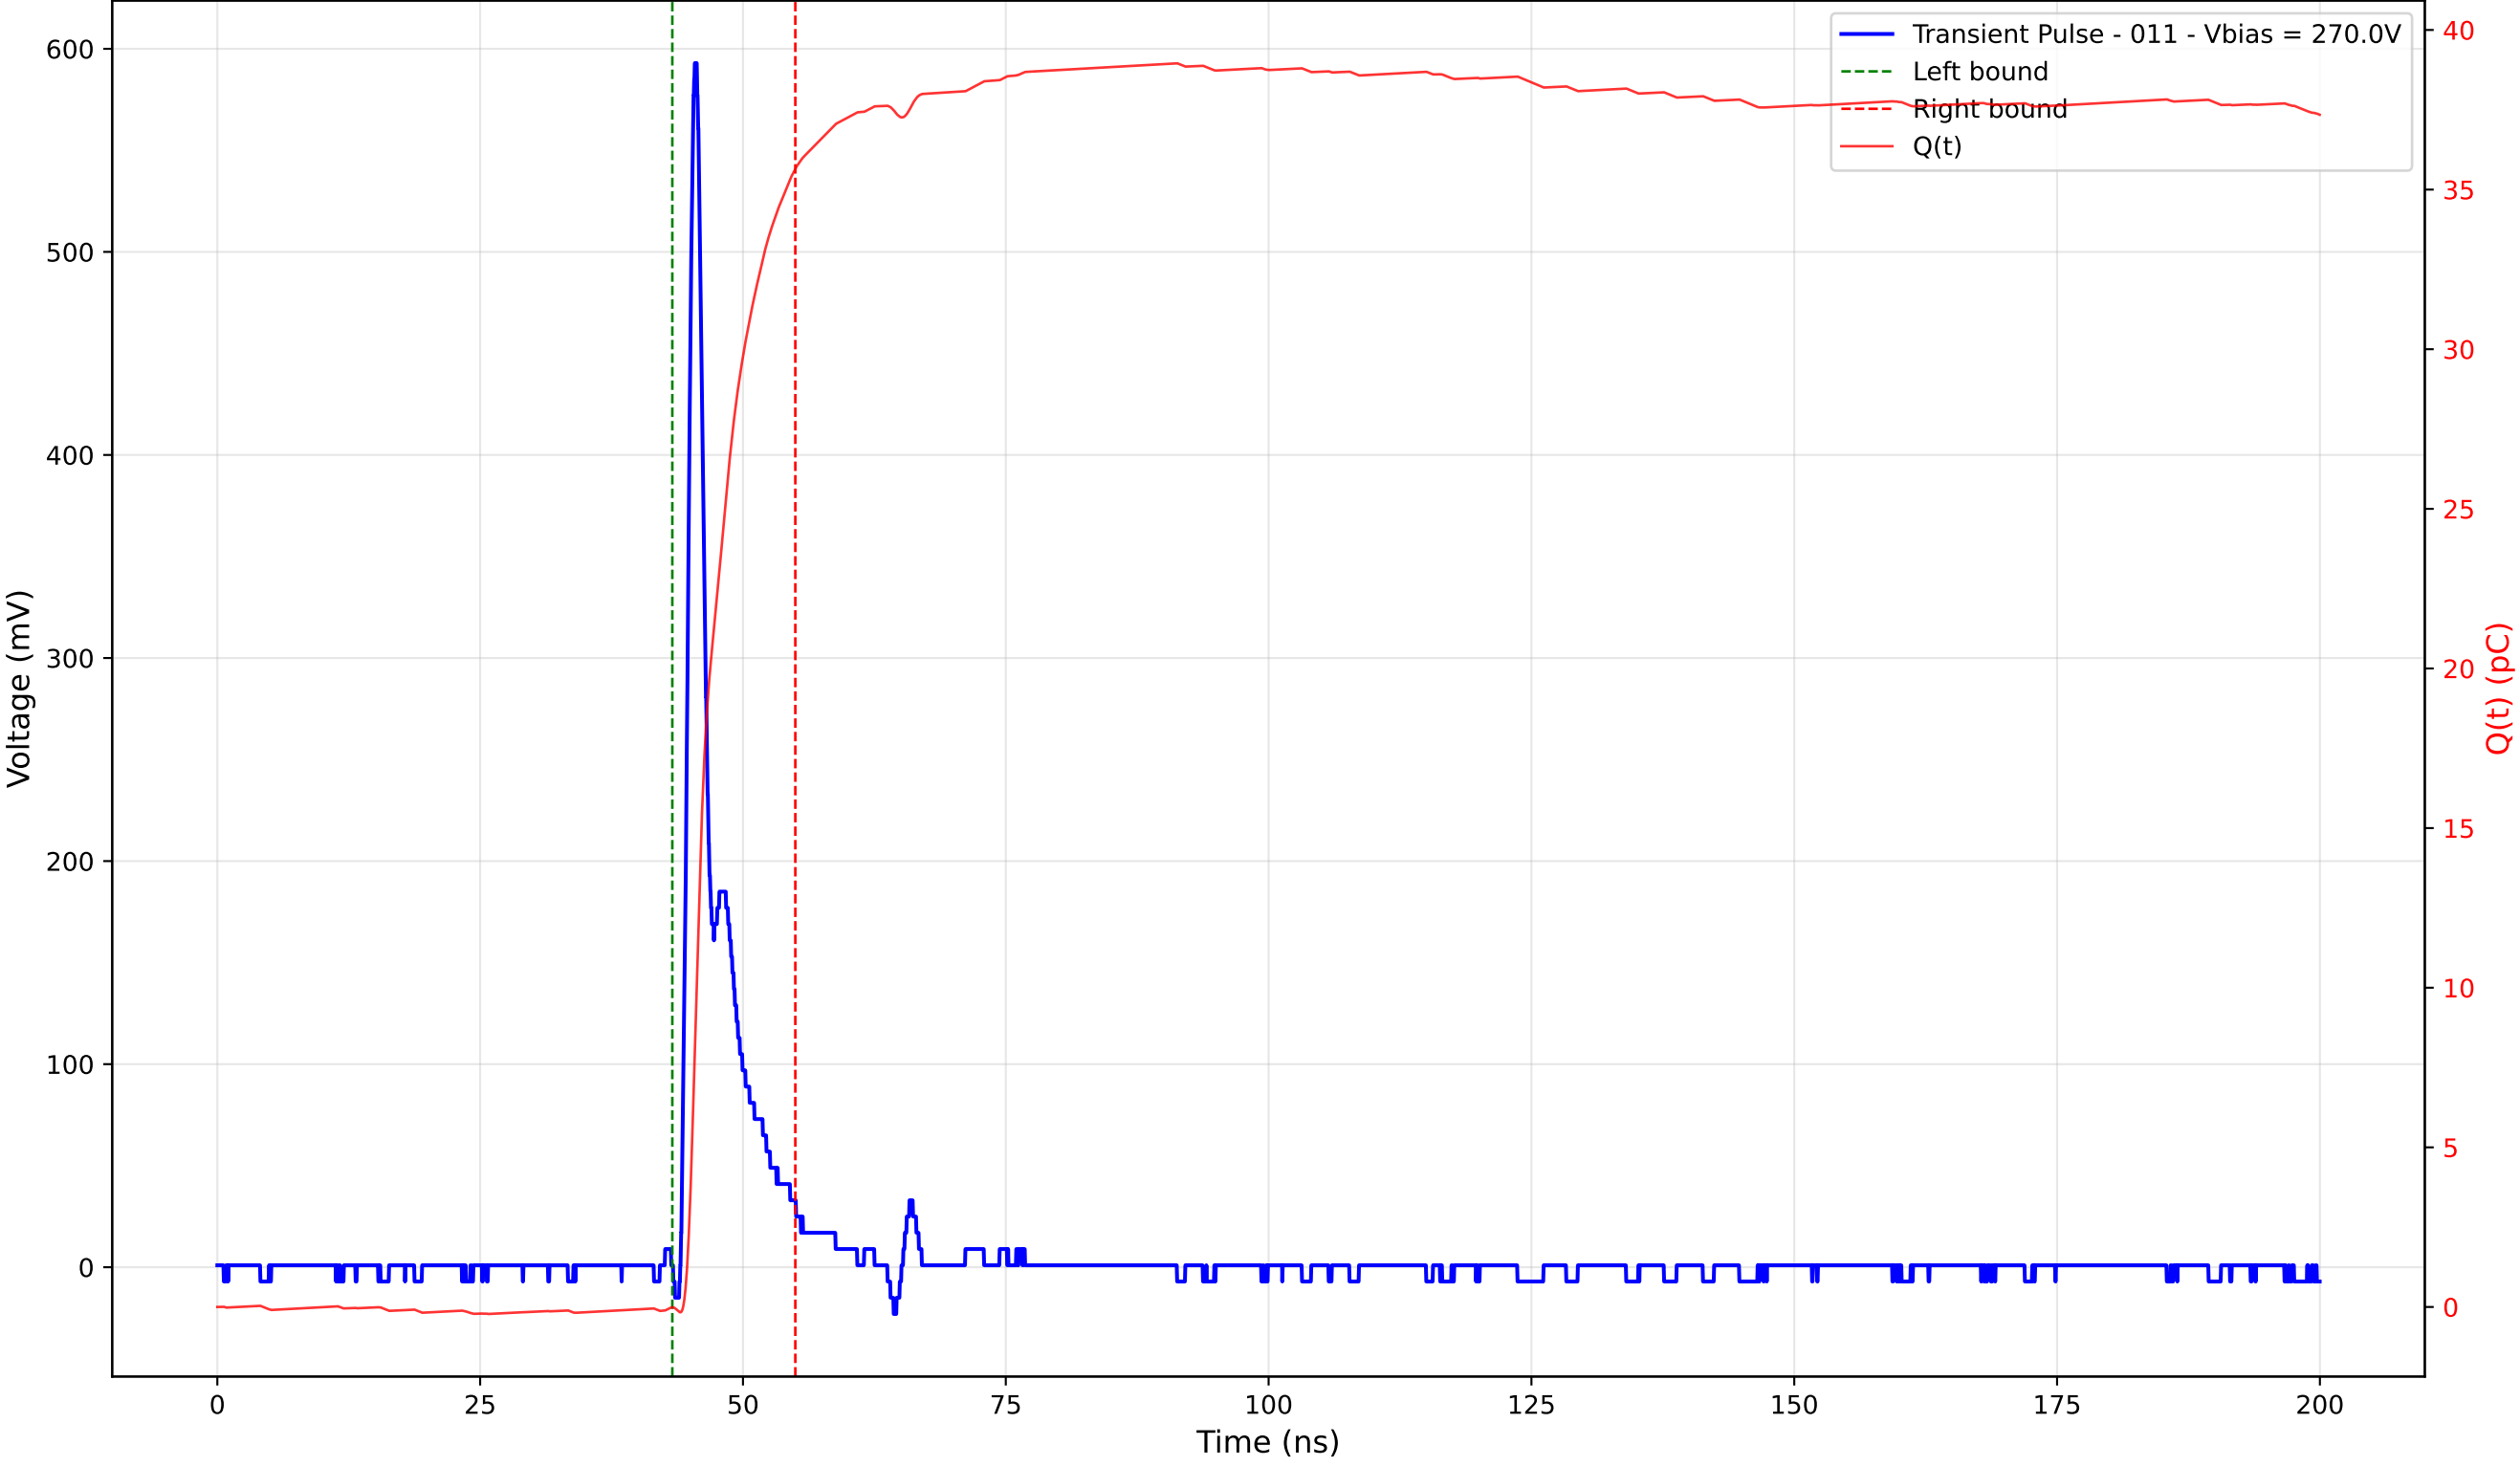


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 35.70 pC - Rise Time: 0.94 ns

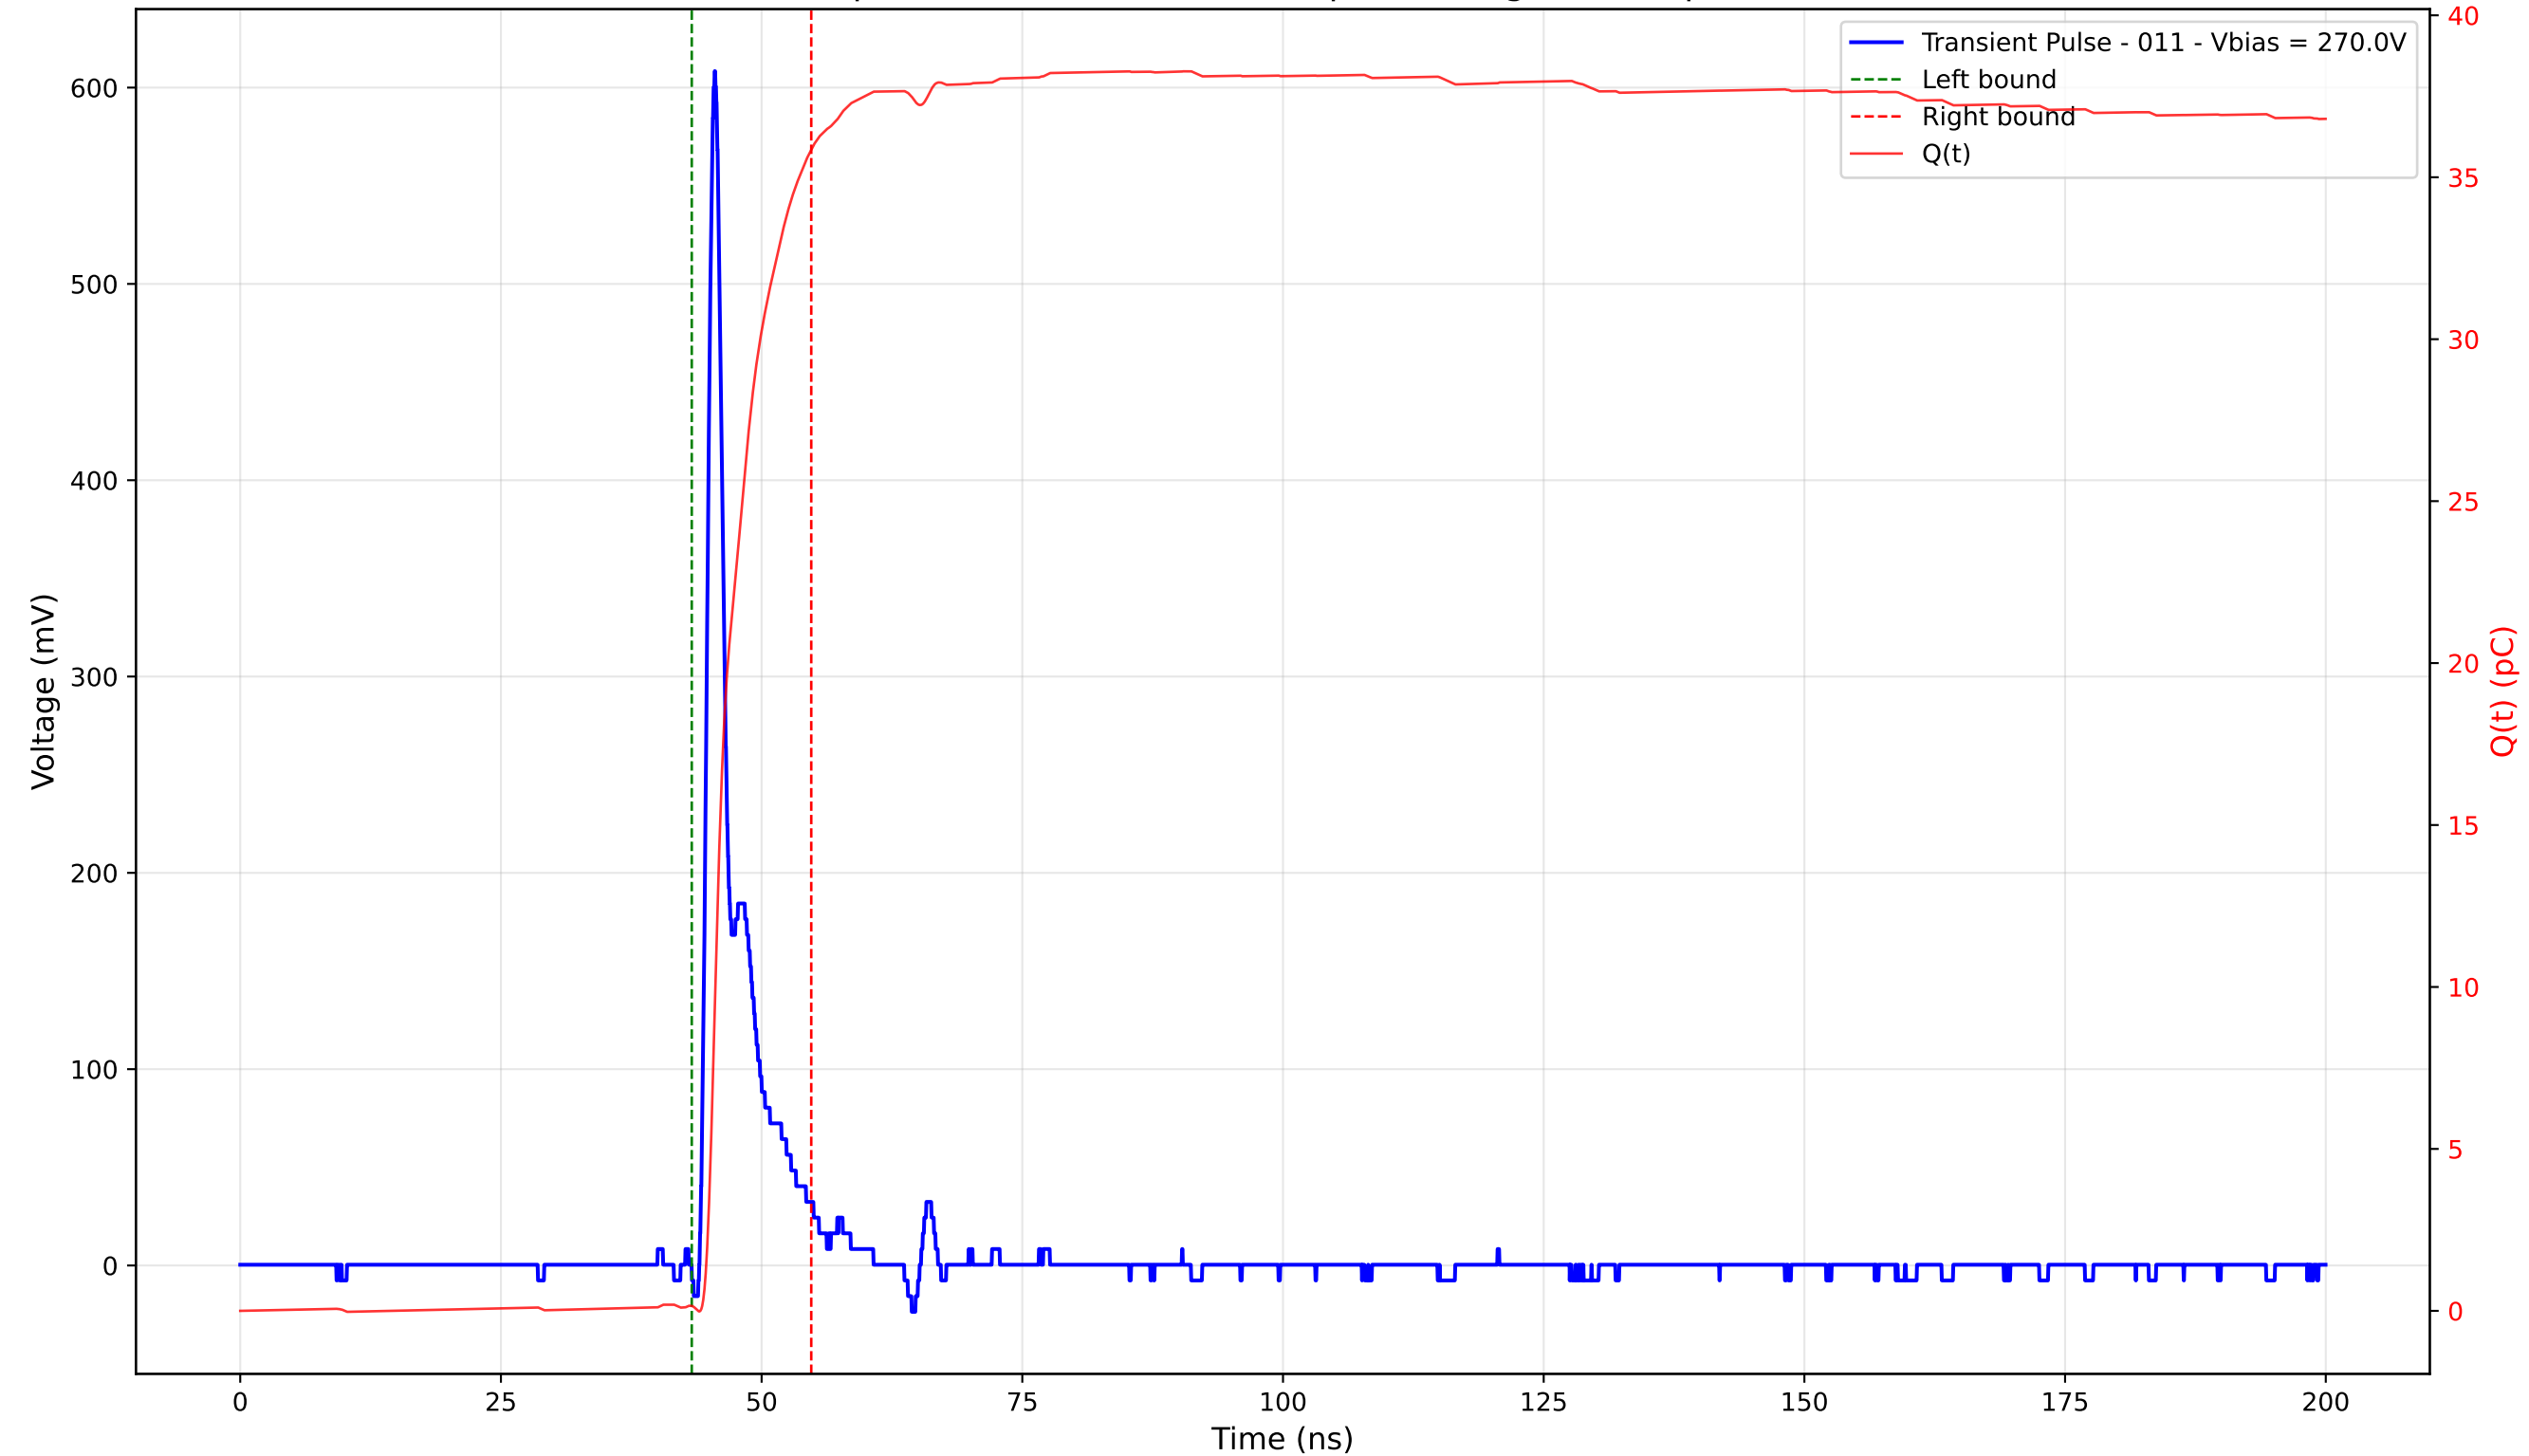


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 35.95 pC - Rise Time: 0.94 ns

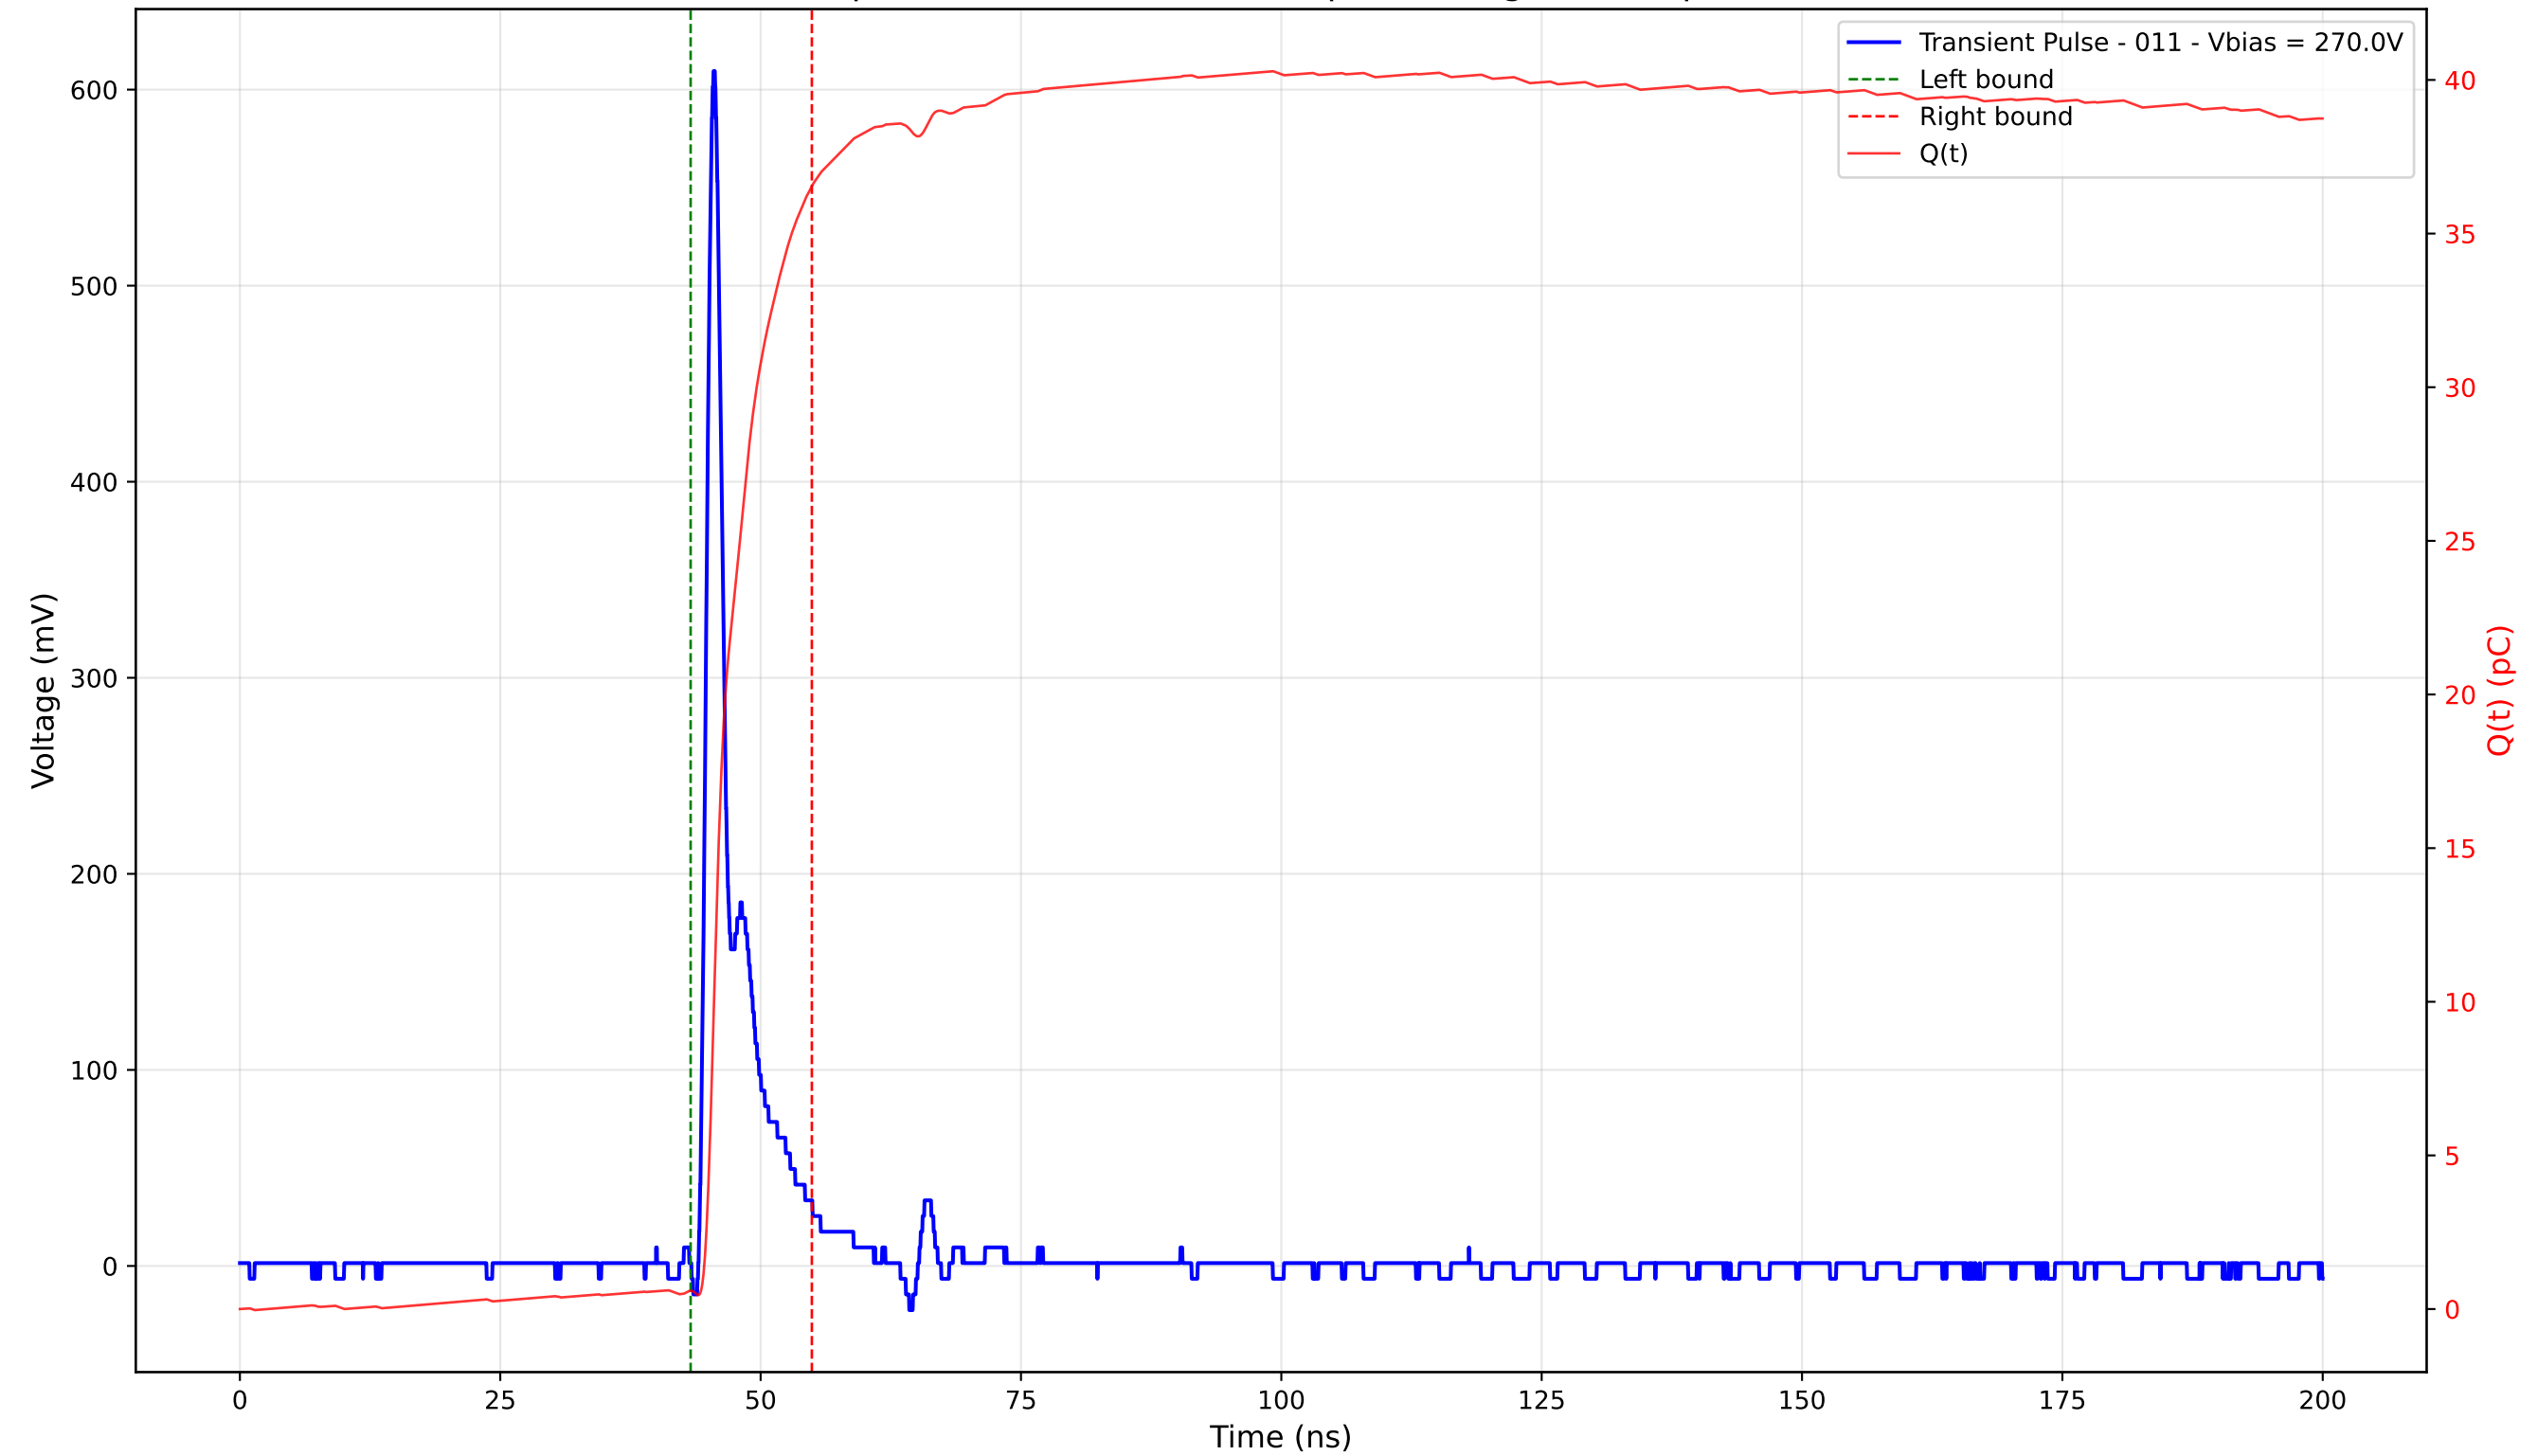


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 35.20 pC - Rise Time: 0.93 ns

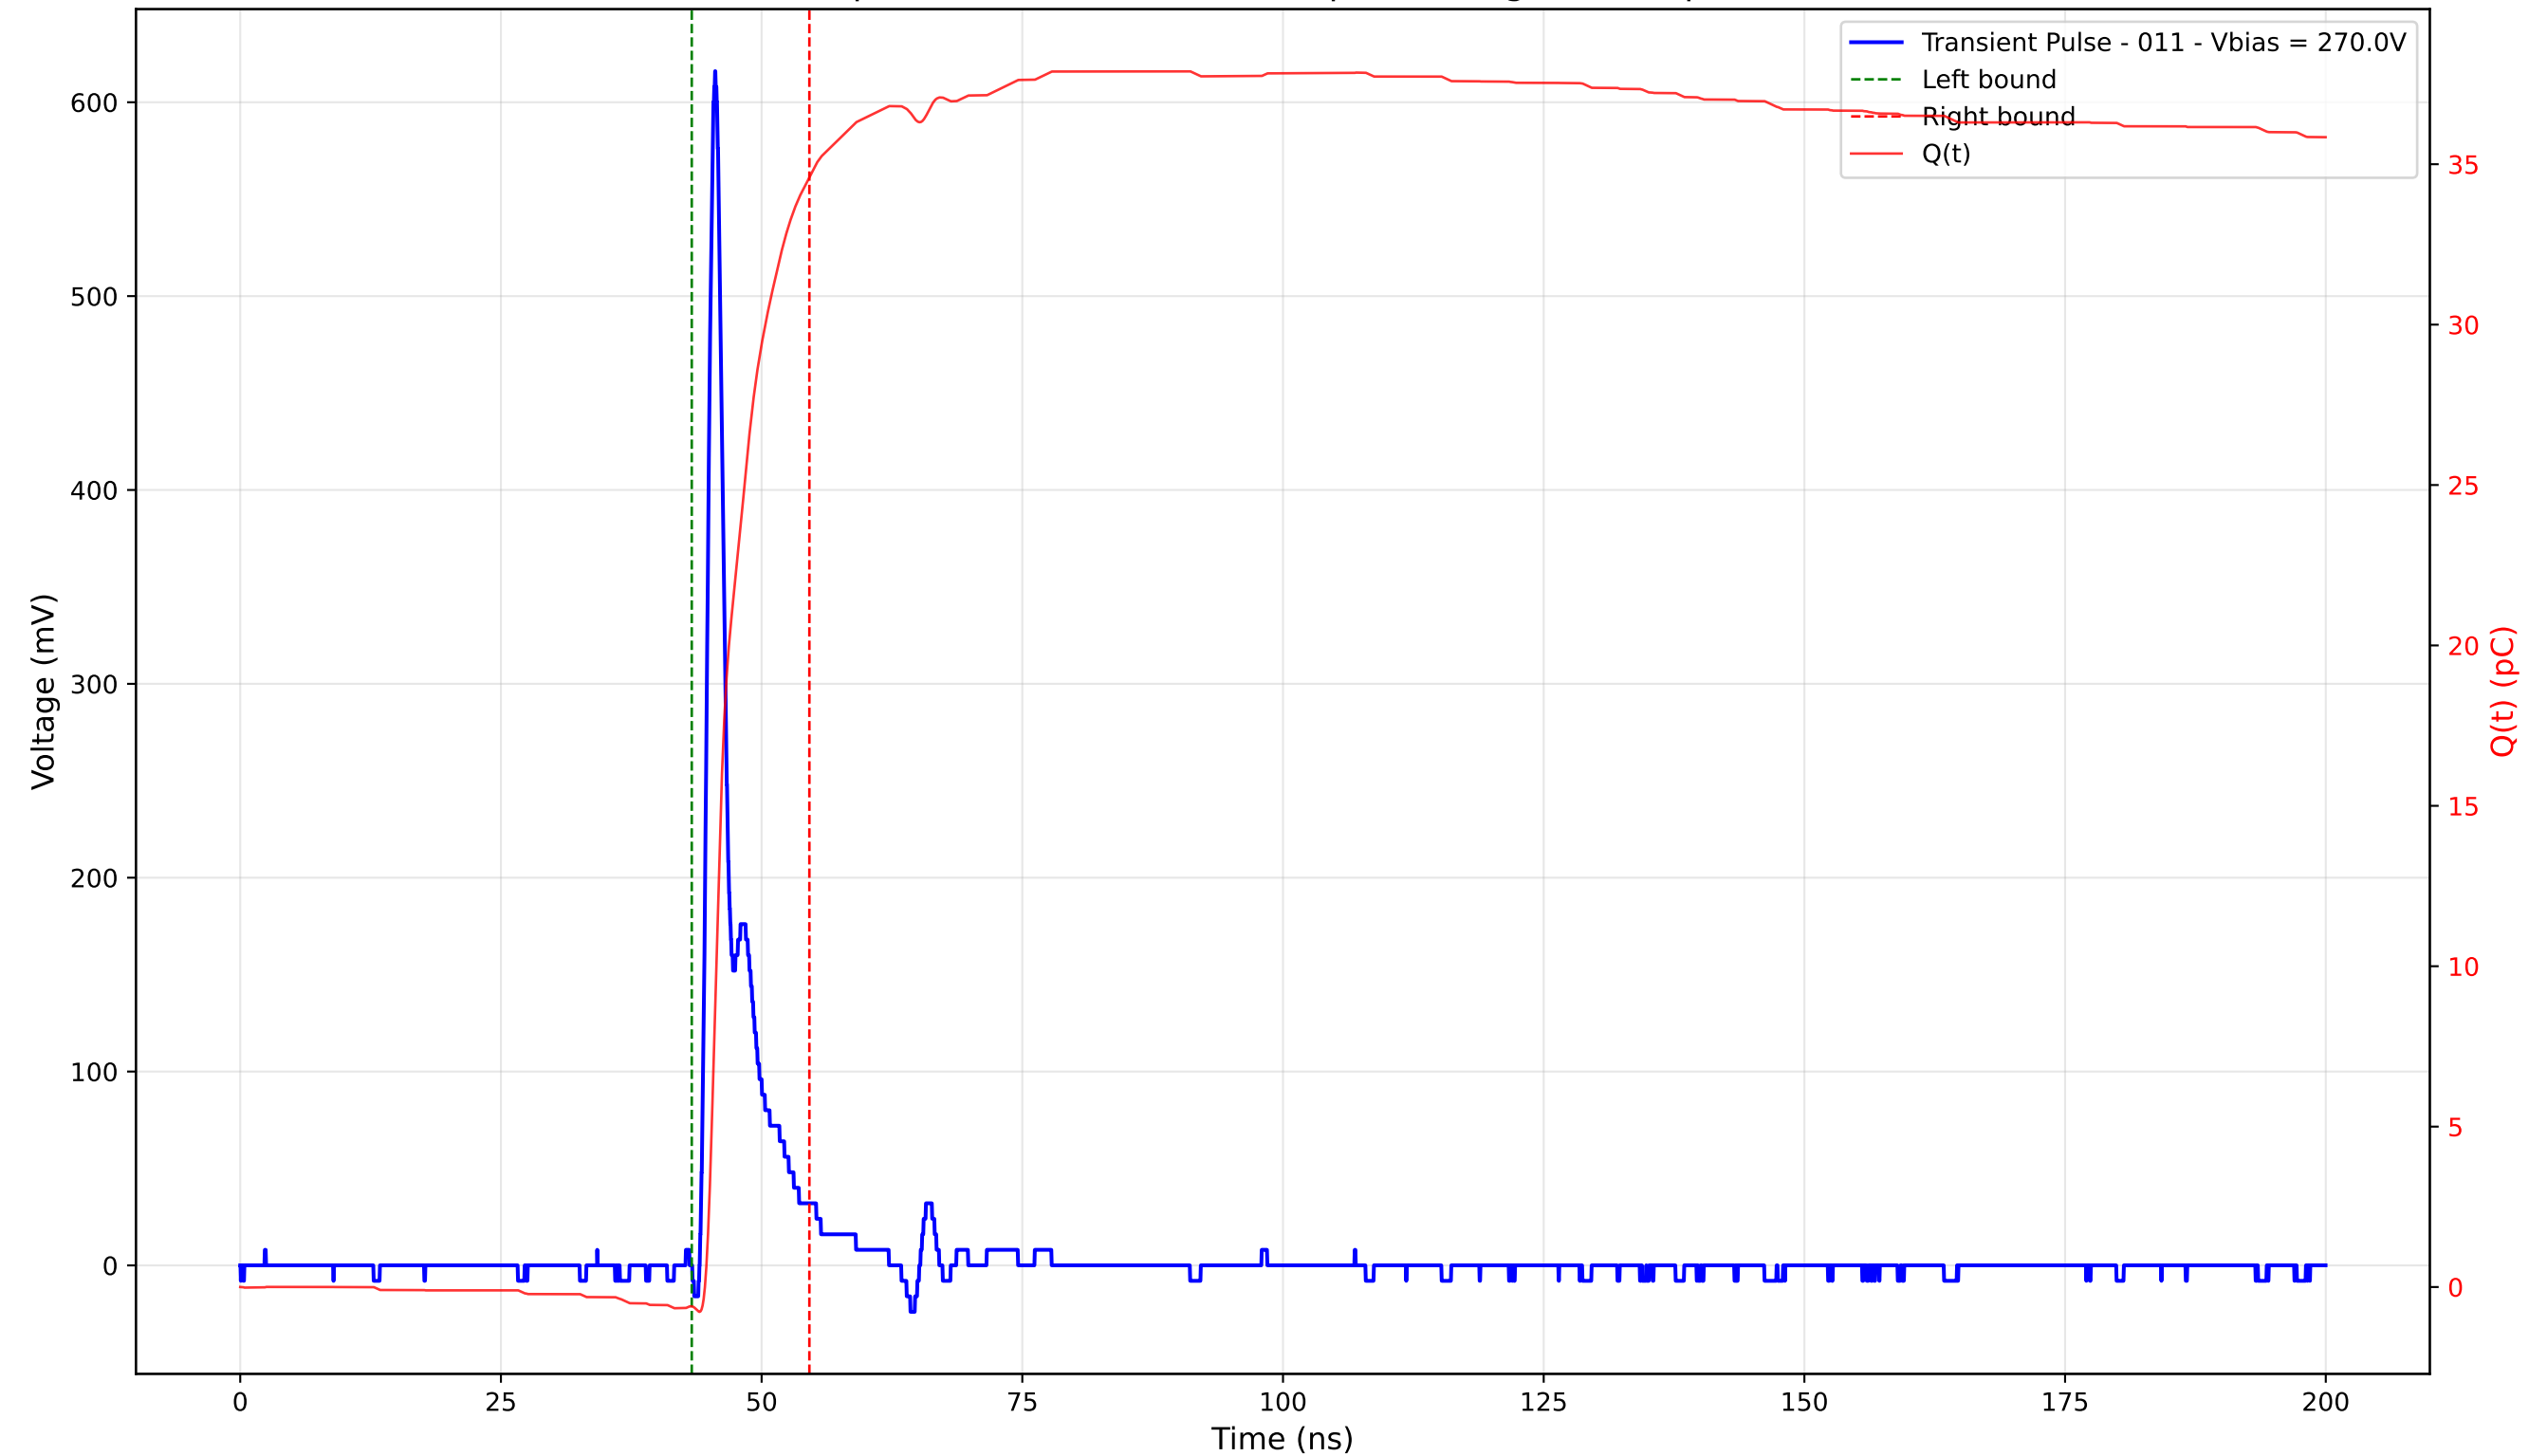


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 35.79 pC - Rise Time: 0.97 ns

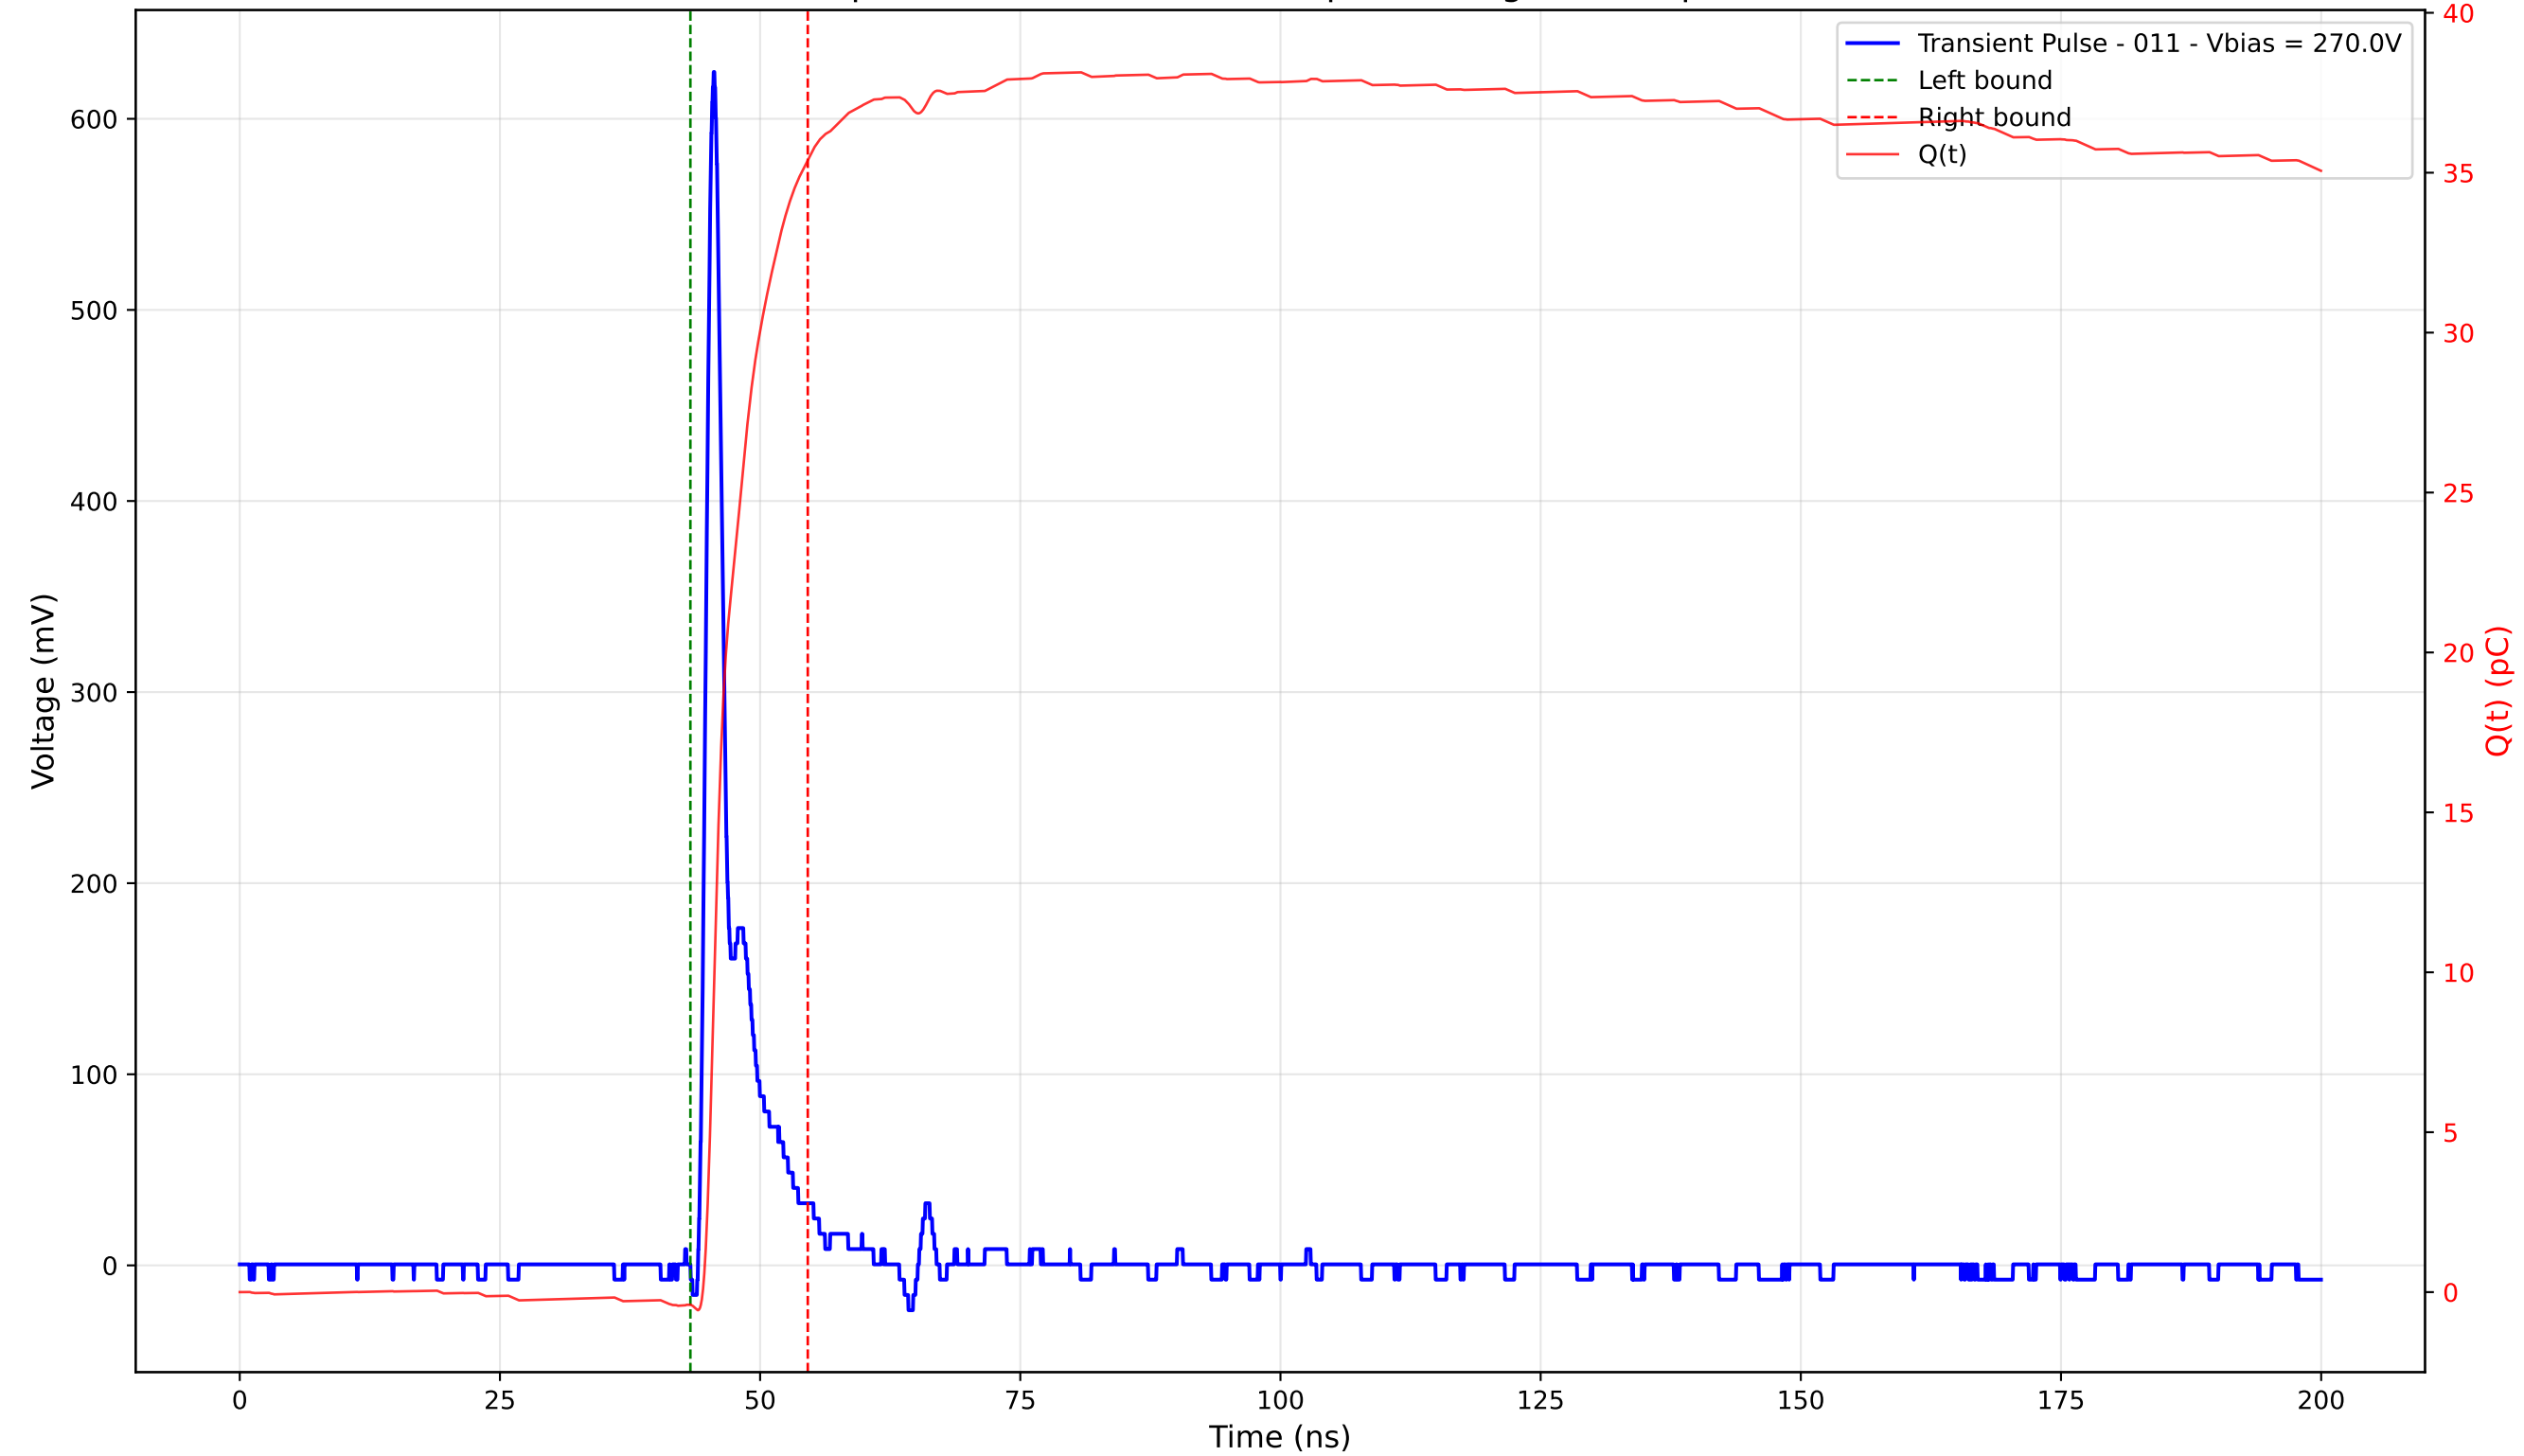


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 35.75 pC - Rise Time: 0.97 ns

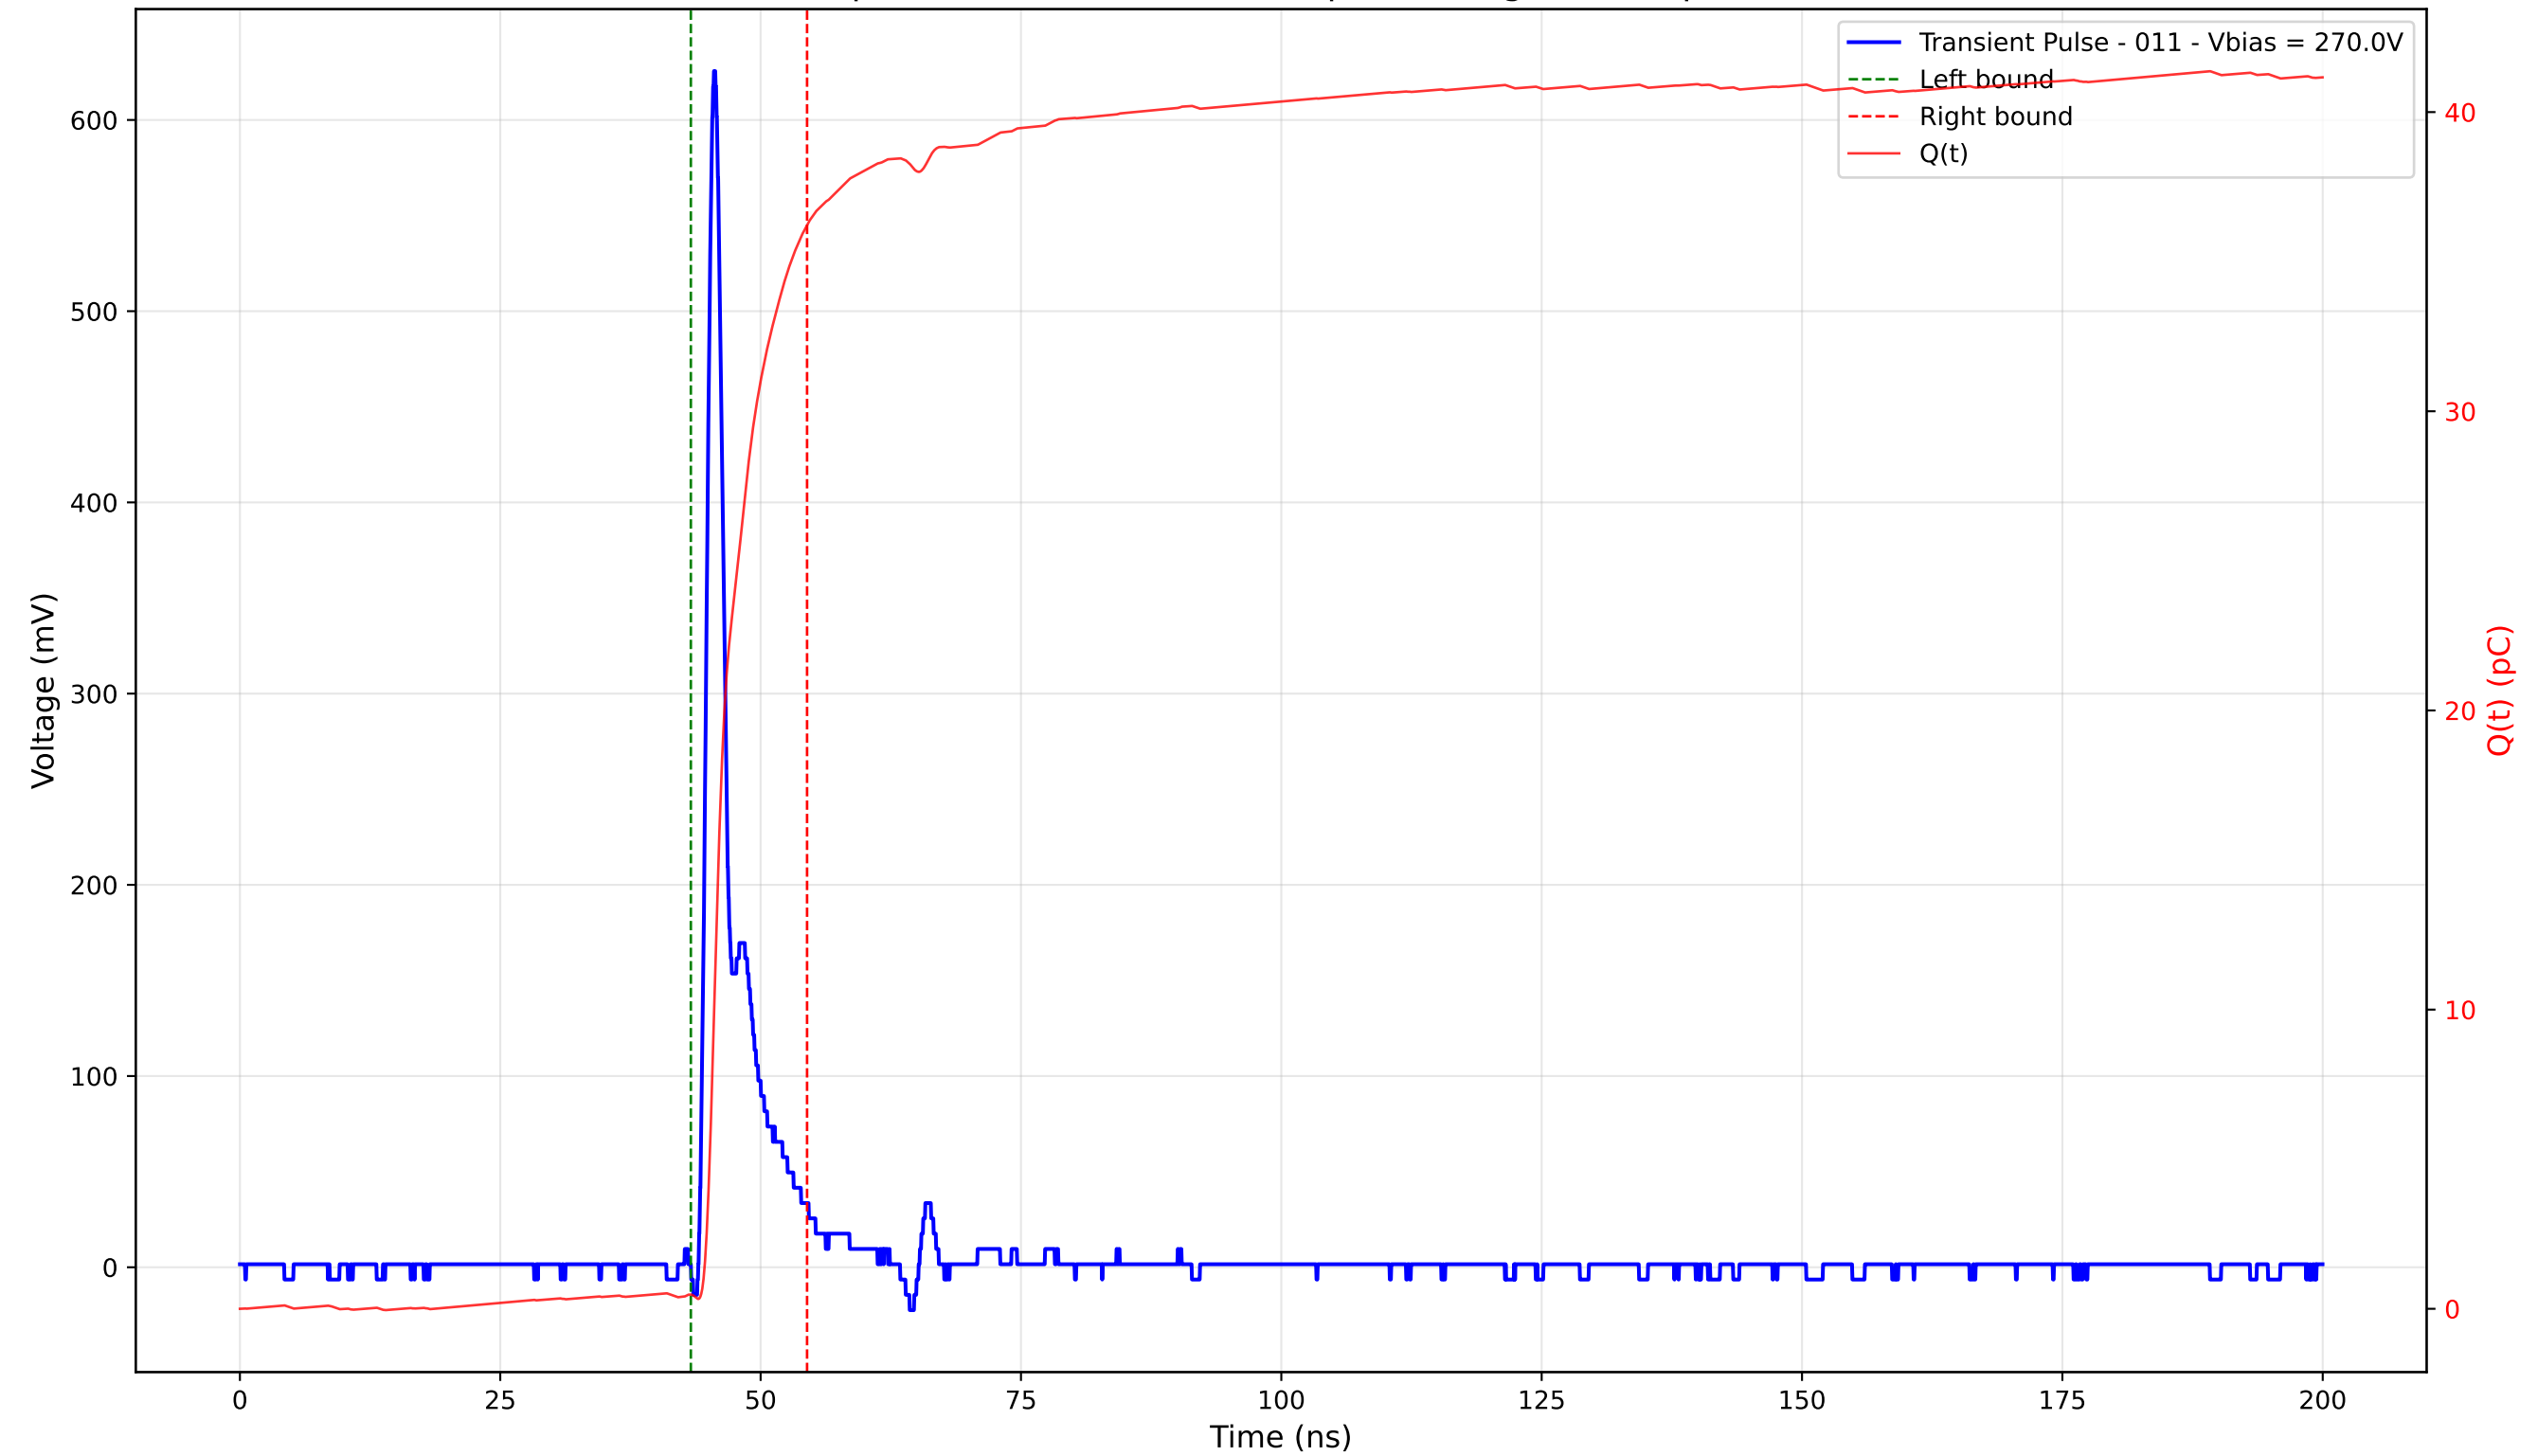


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 35.62 pC - Rise Time: 0.97 ns

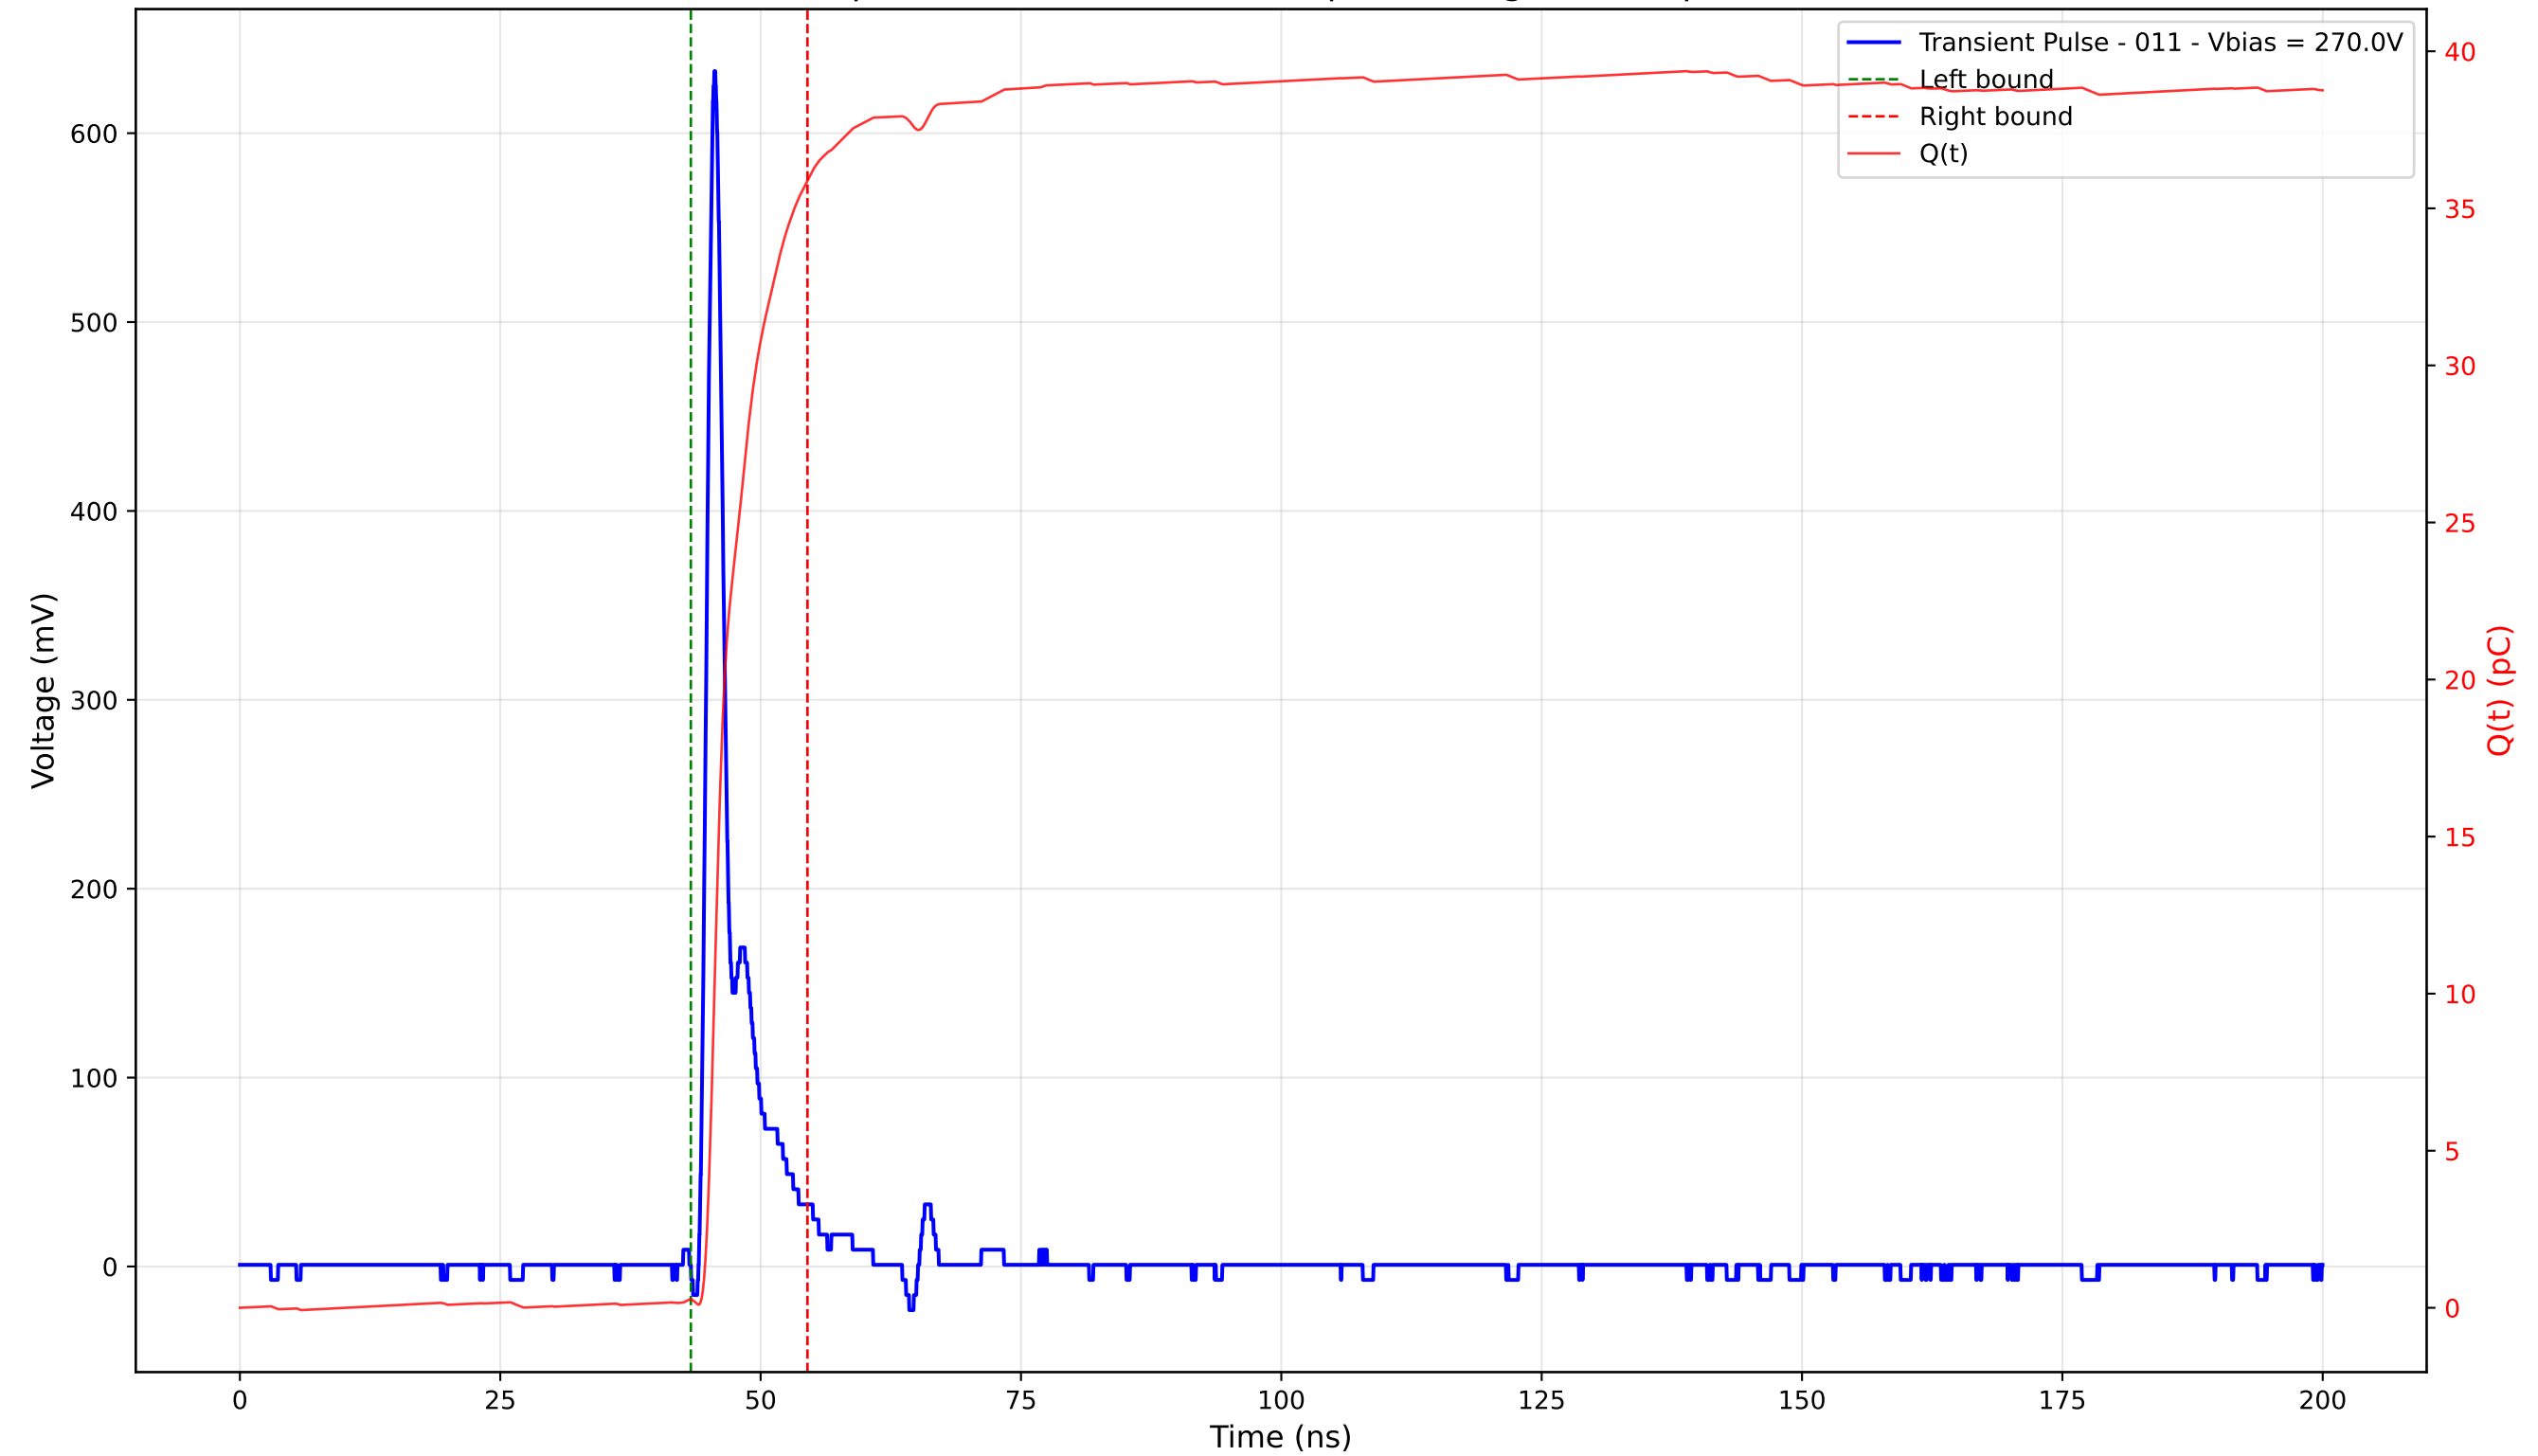


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 36.27 pC - Rise Time: 1.00 ns

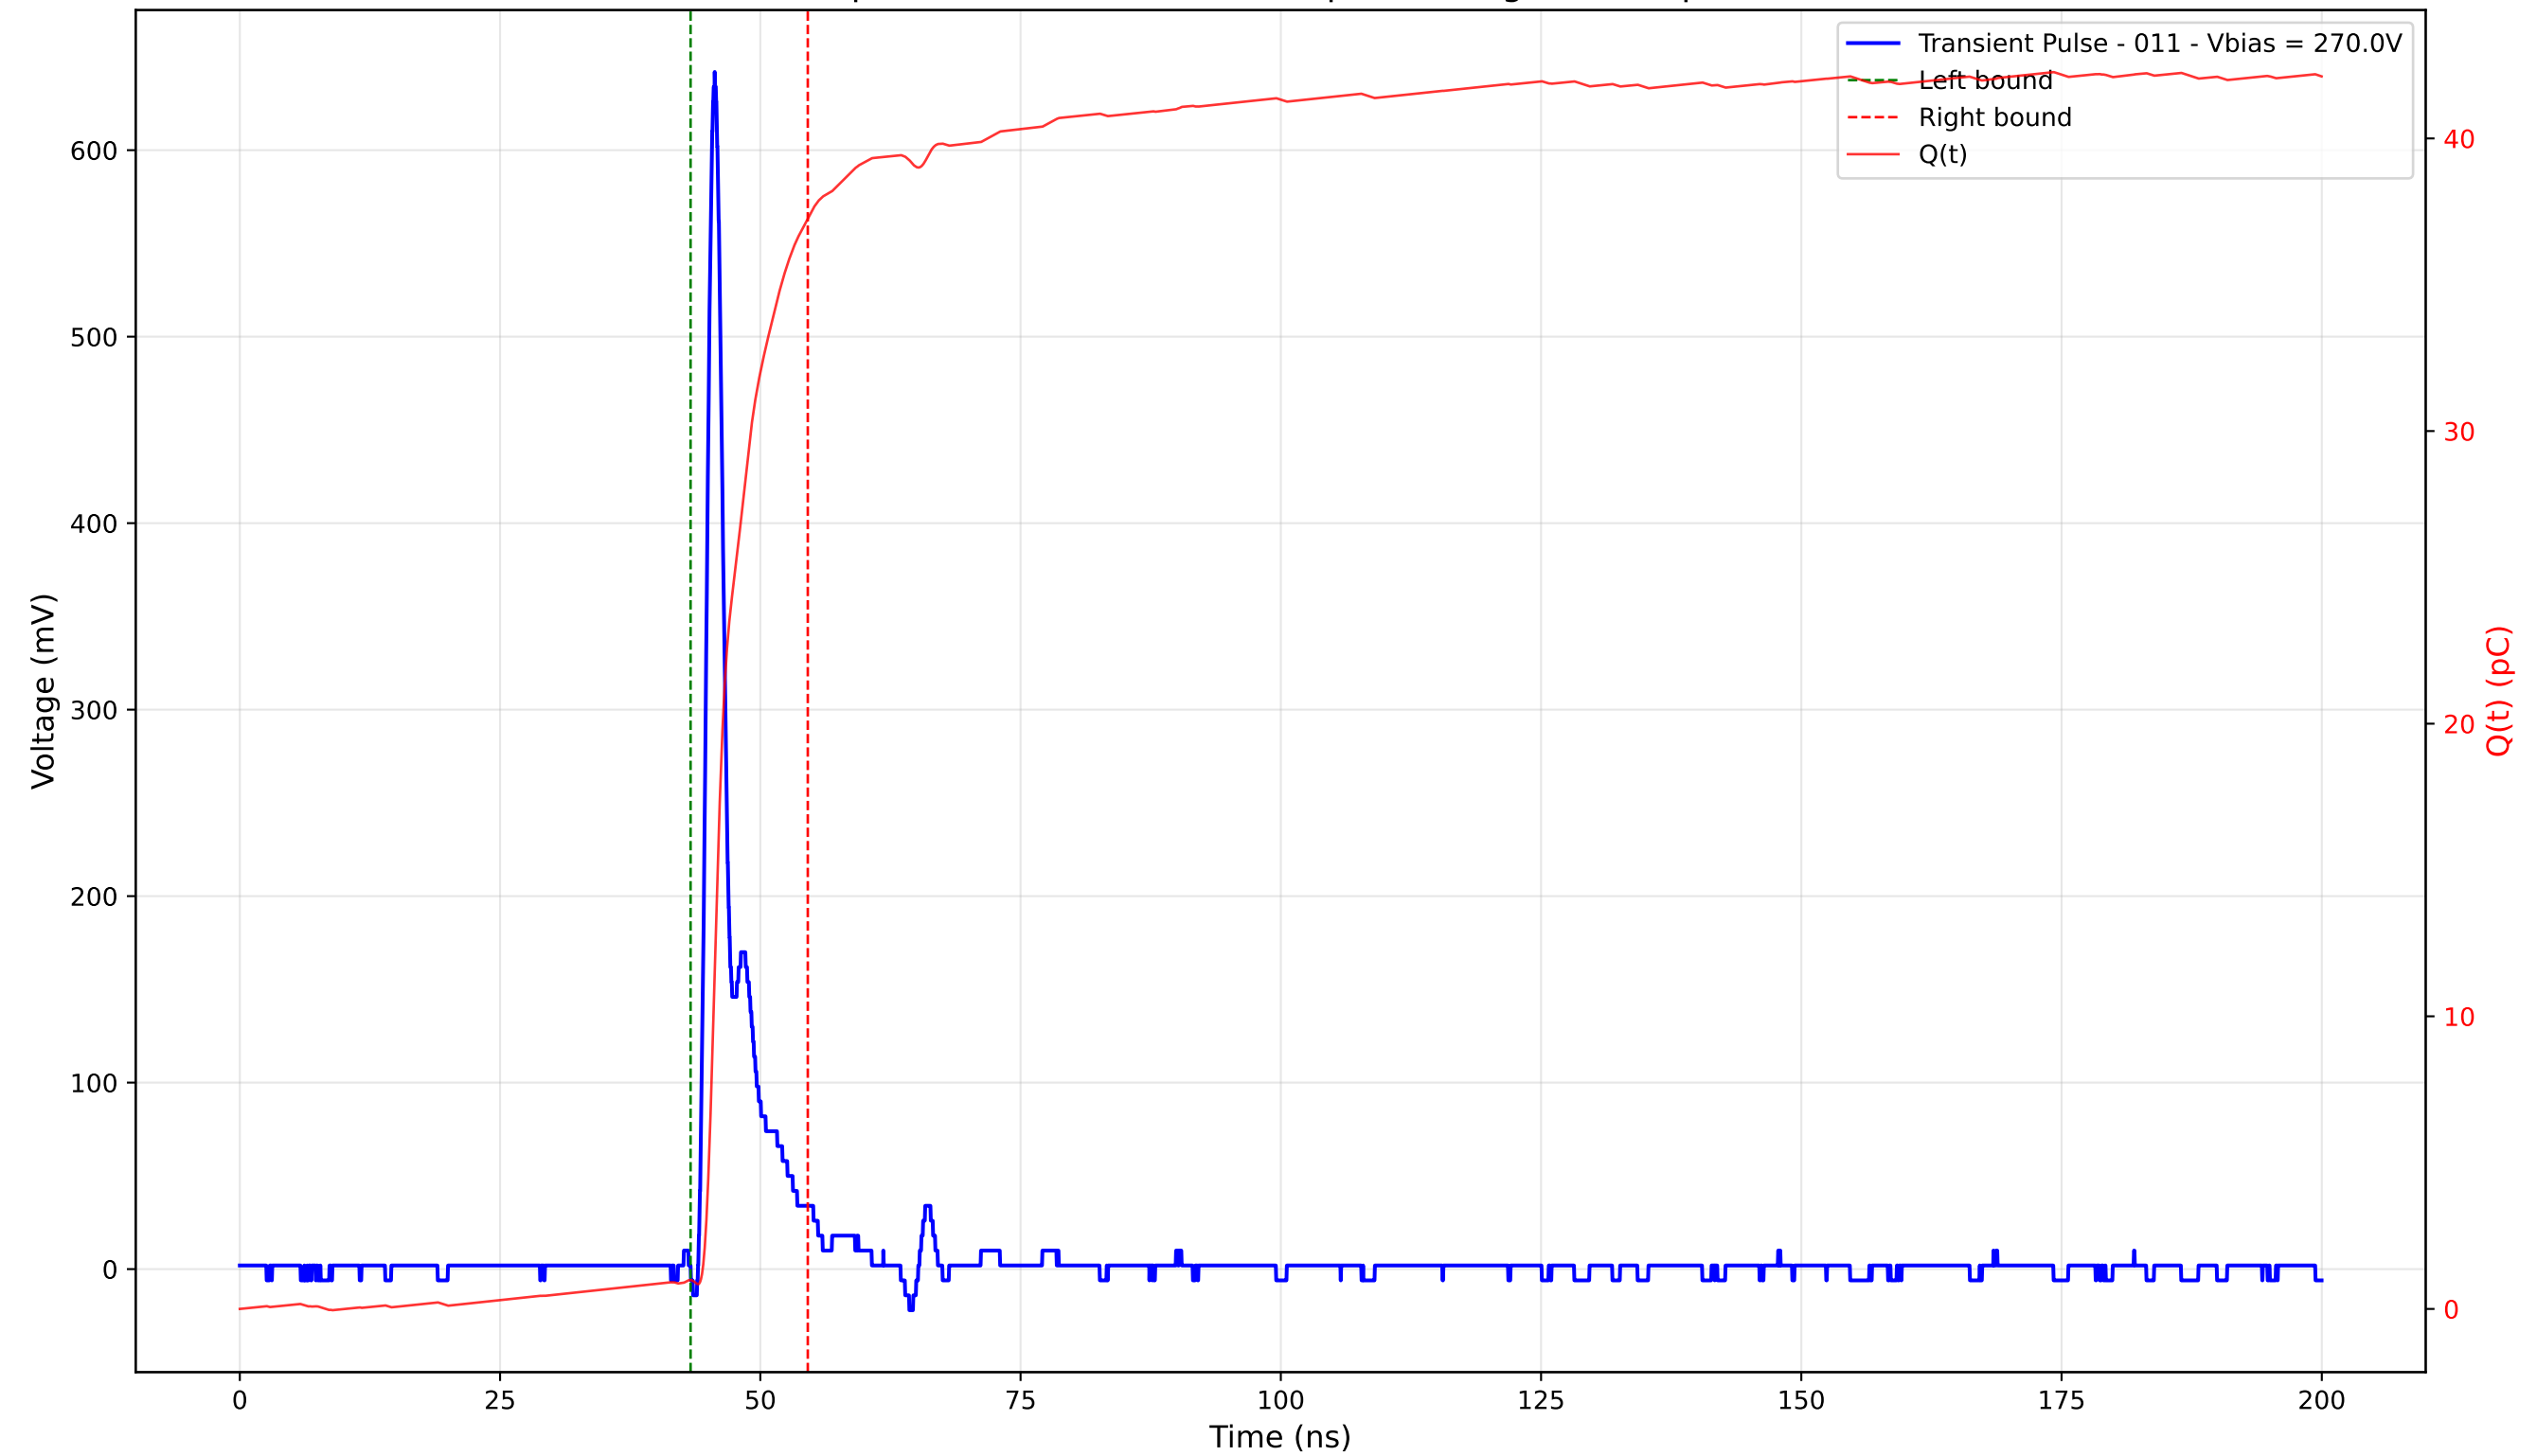


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 36.27 pC - Rise Time: 0.99 ns

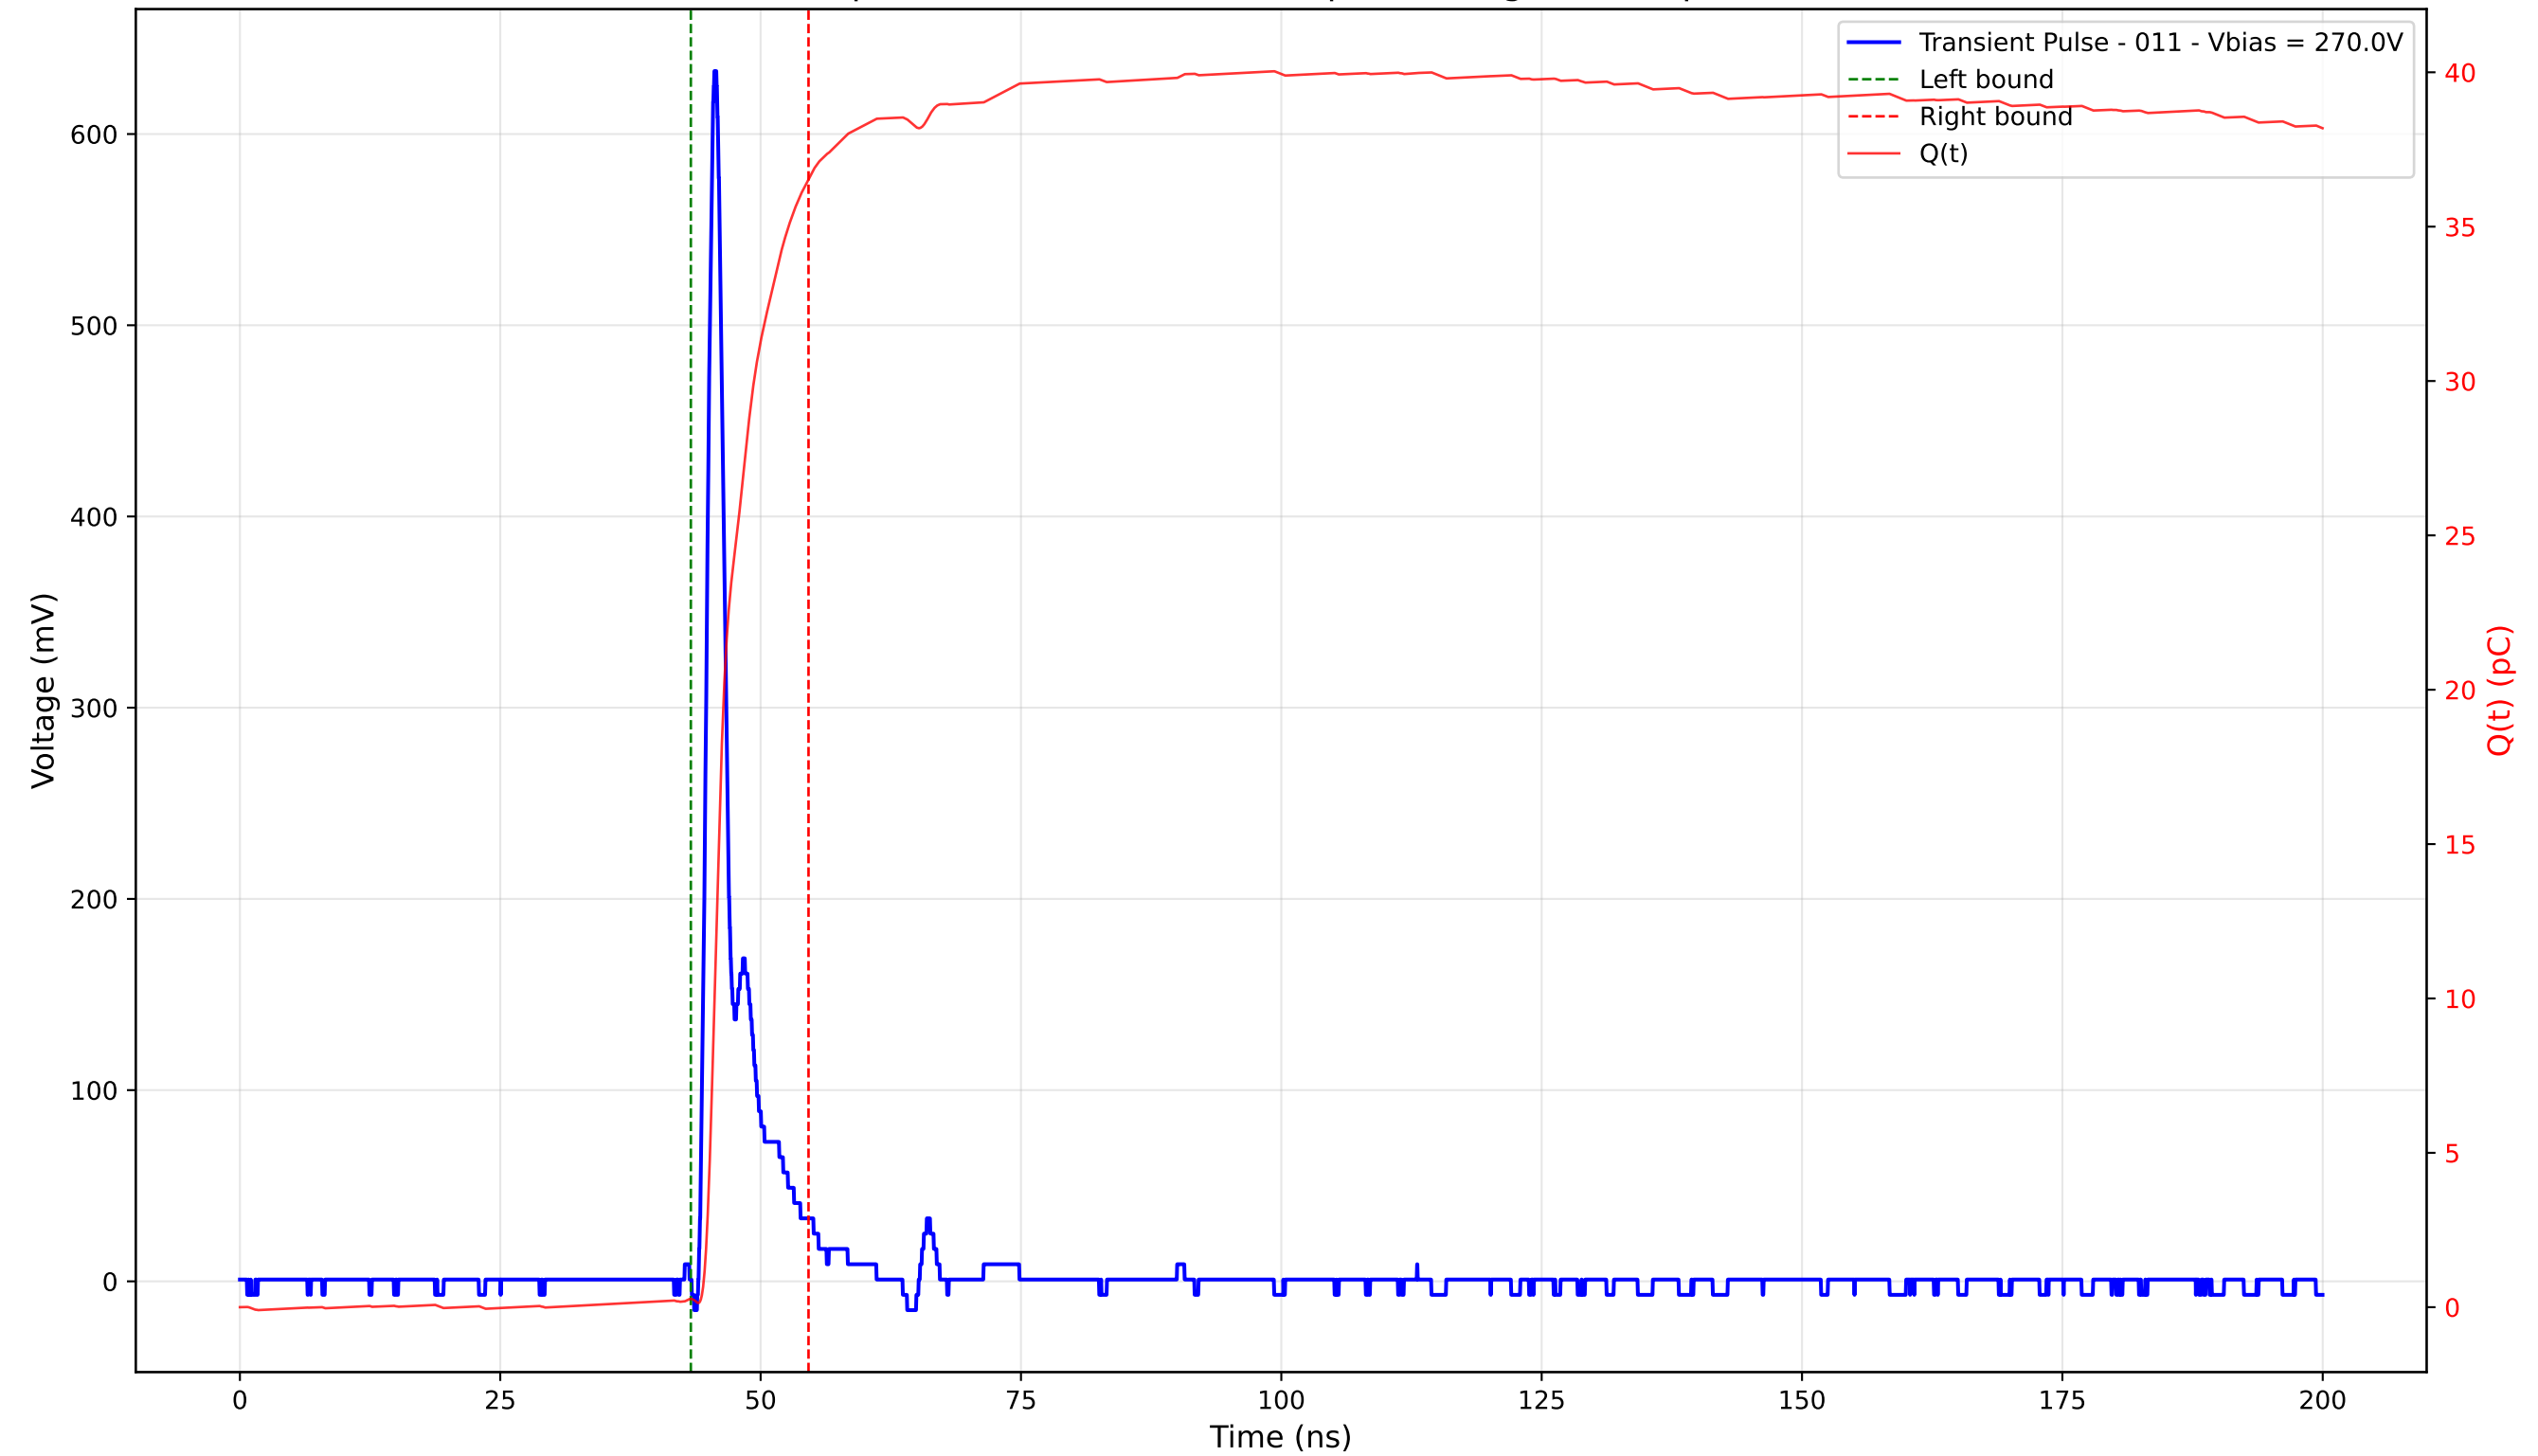


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 36.47 pC - Rise Time: 1.00 ns

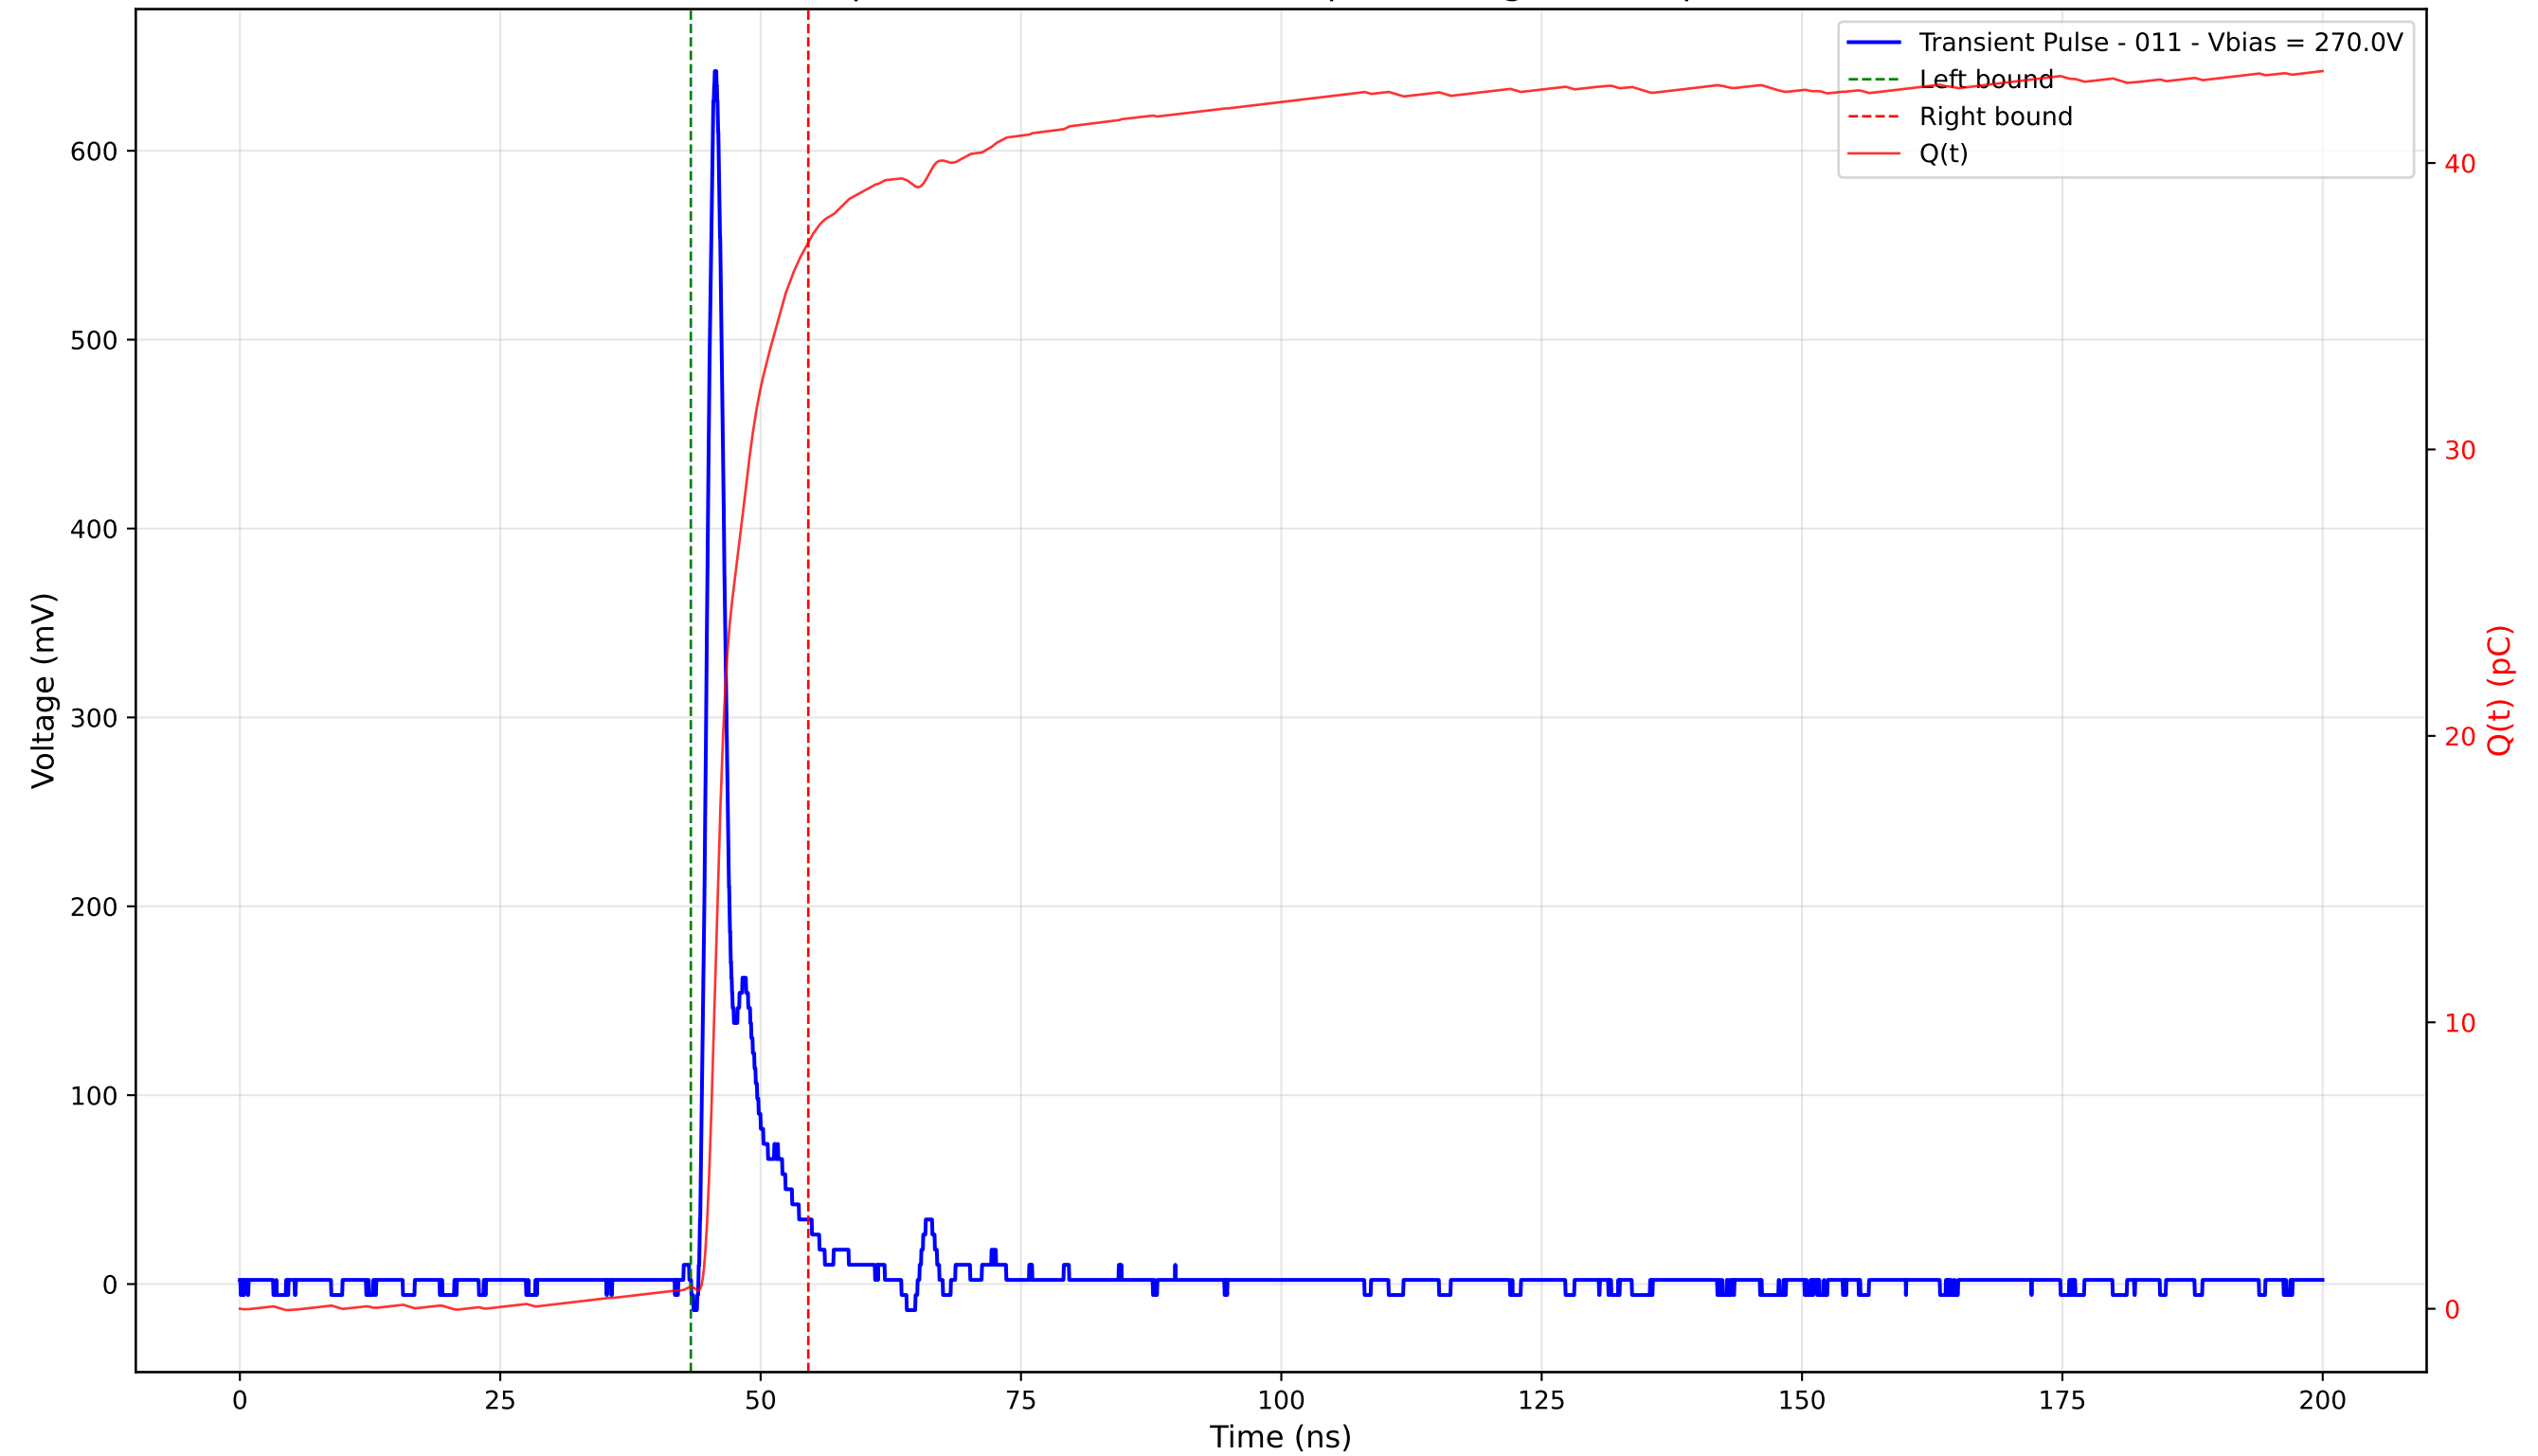


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 35.78 pC - Rise Time: 1.02 ns

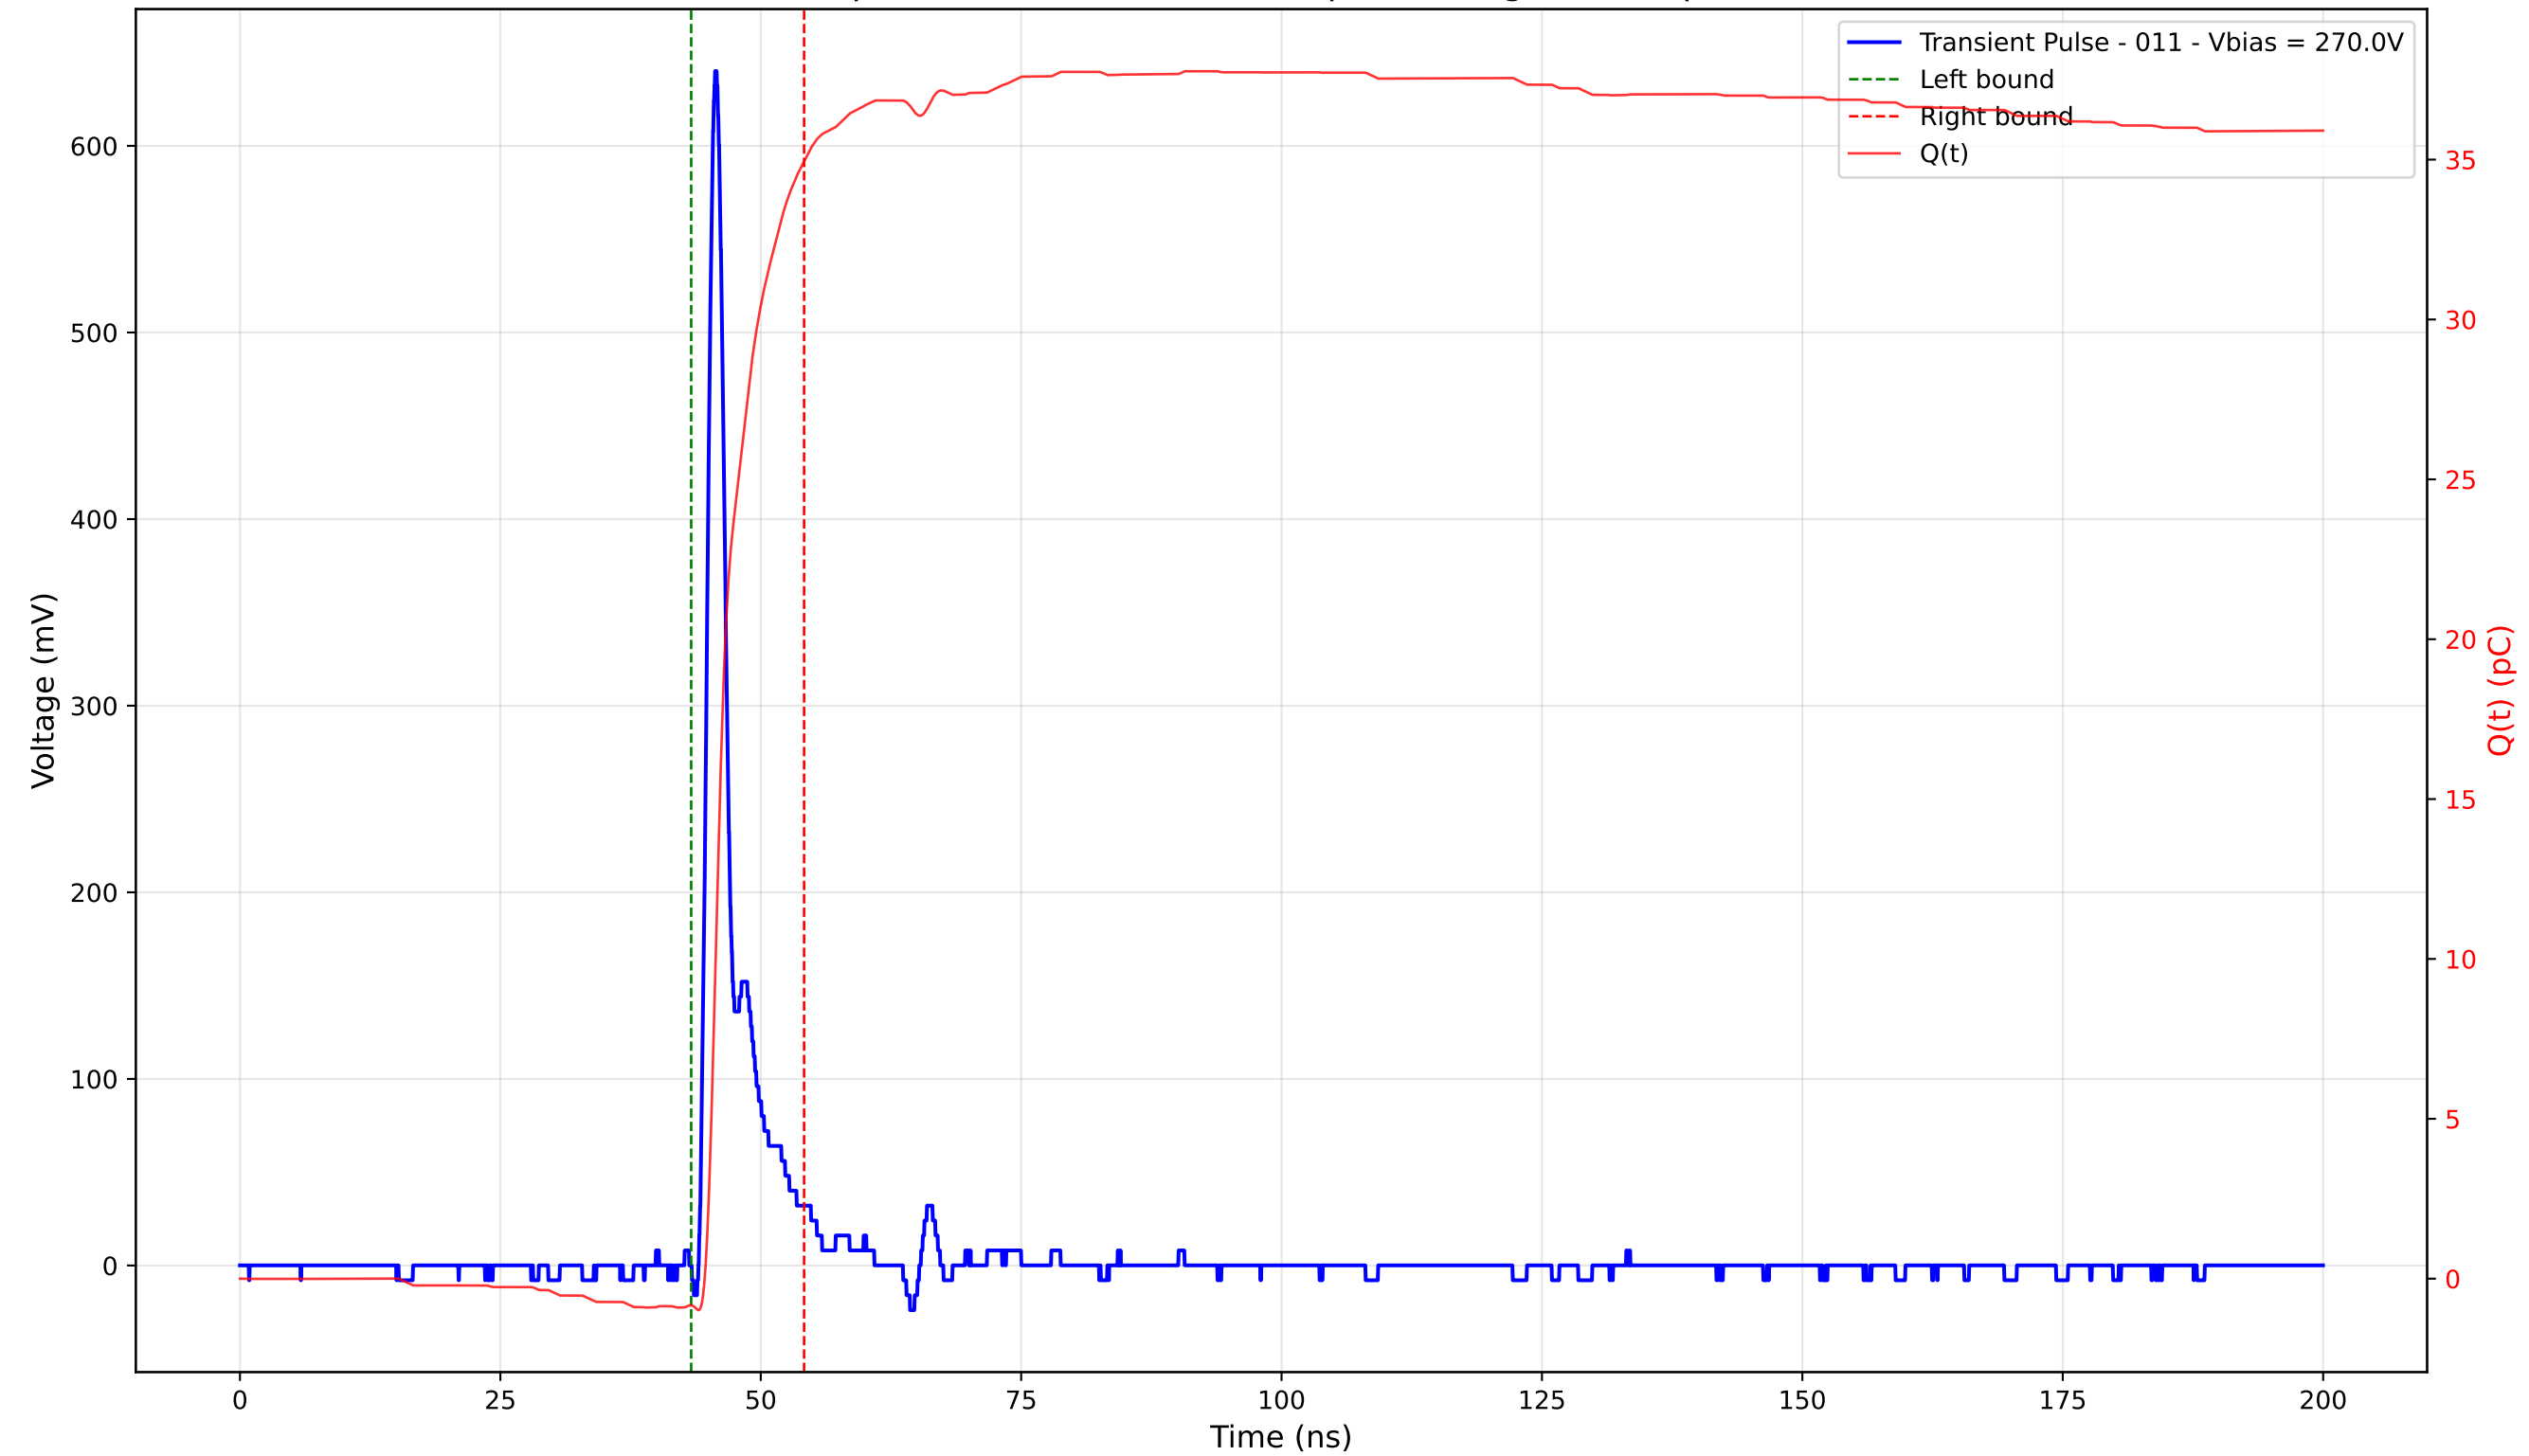


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 35.58 pC - Rise Time: 1.04 ns

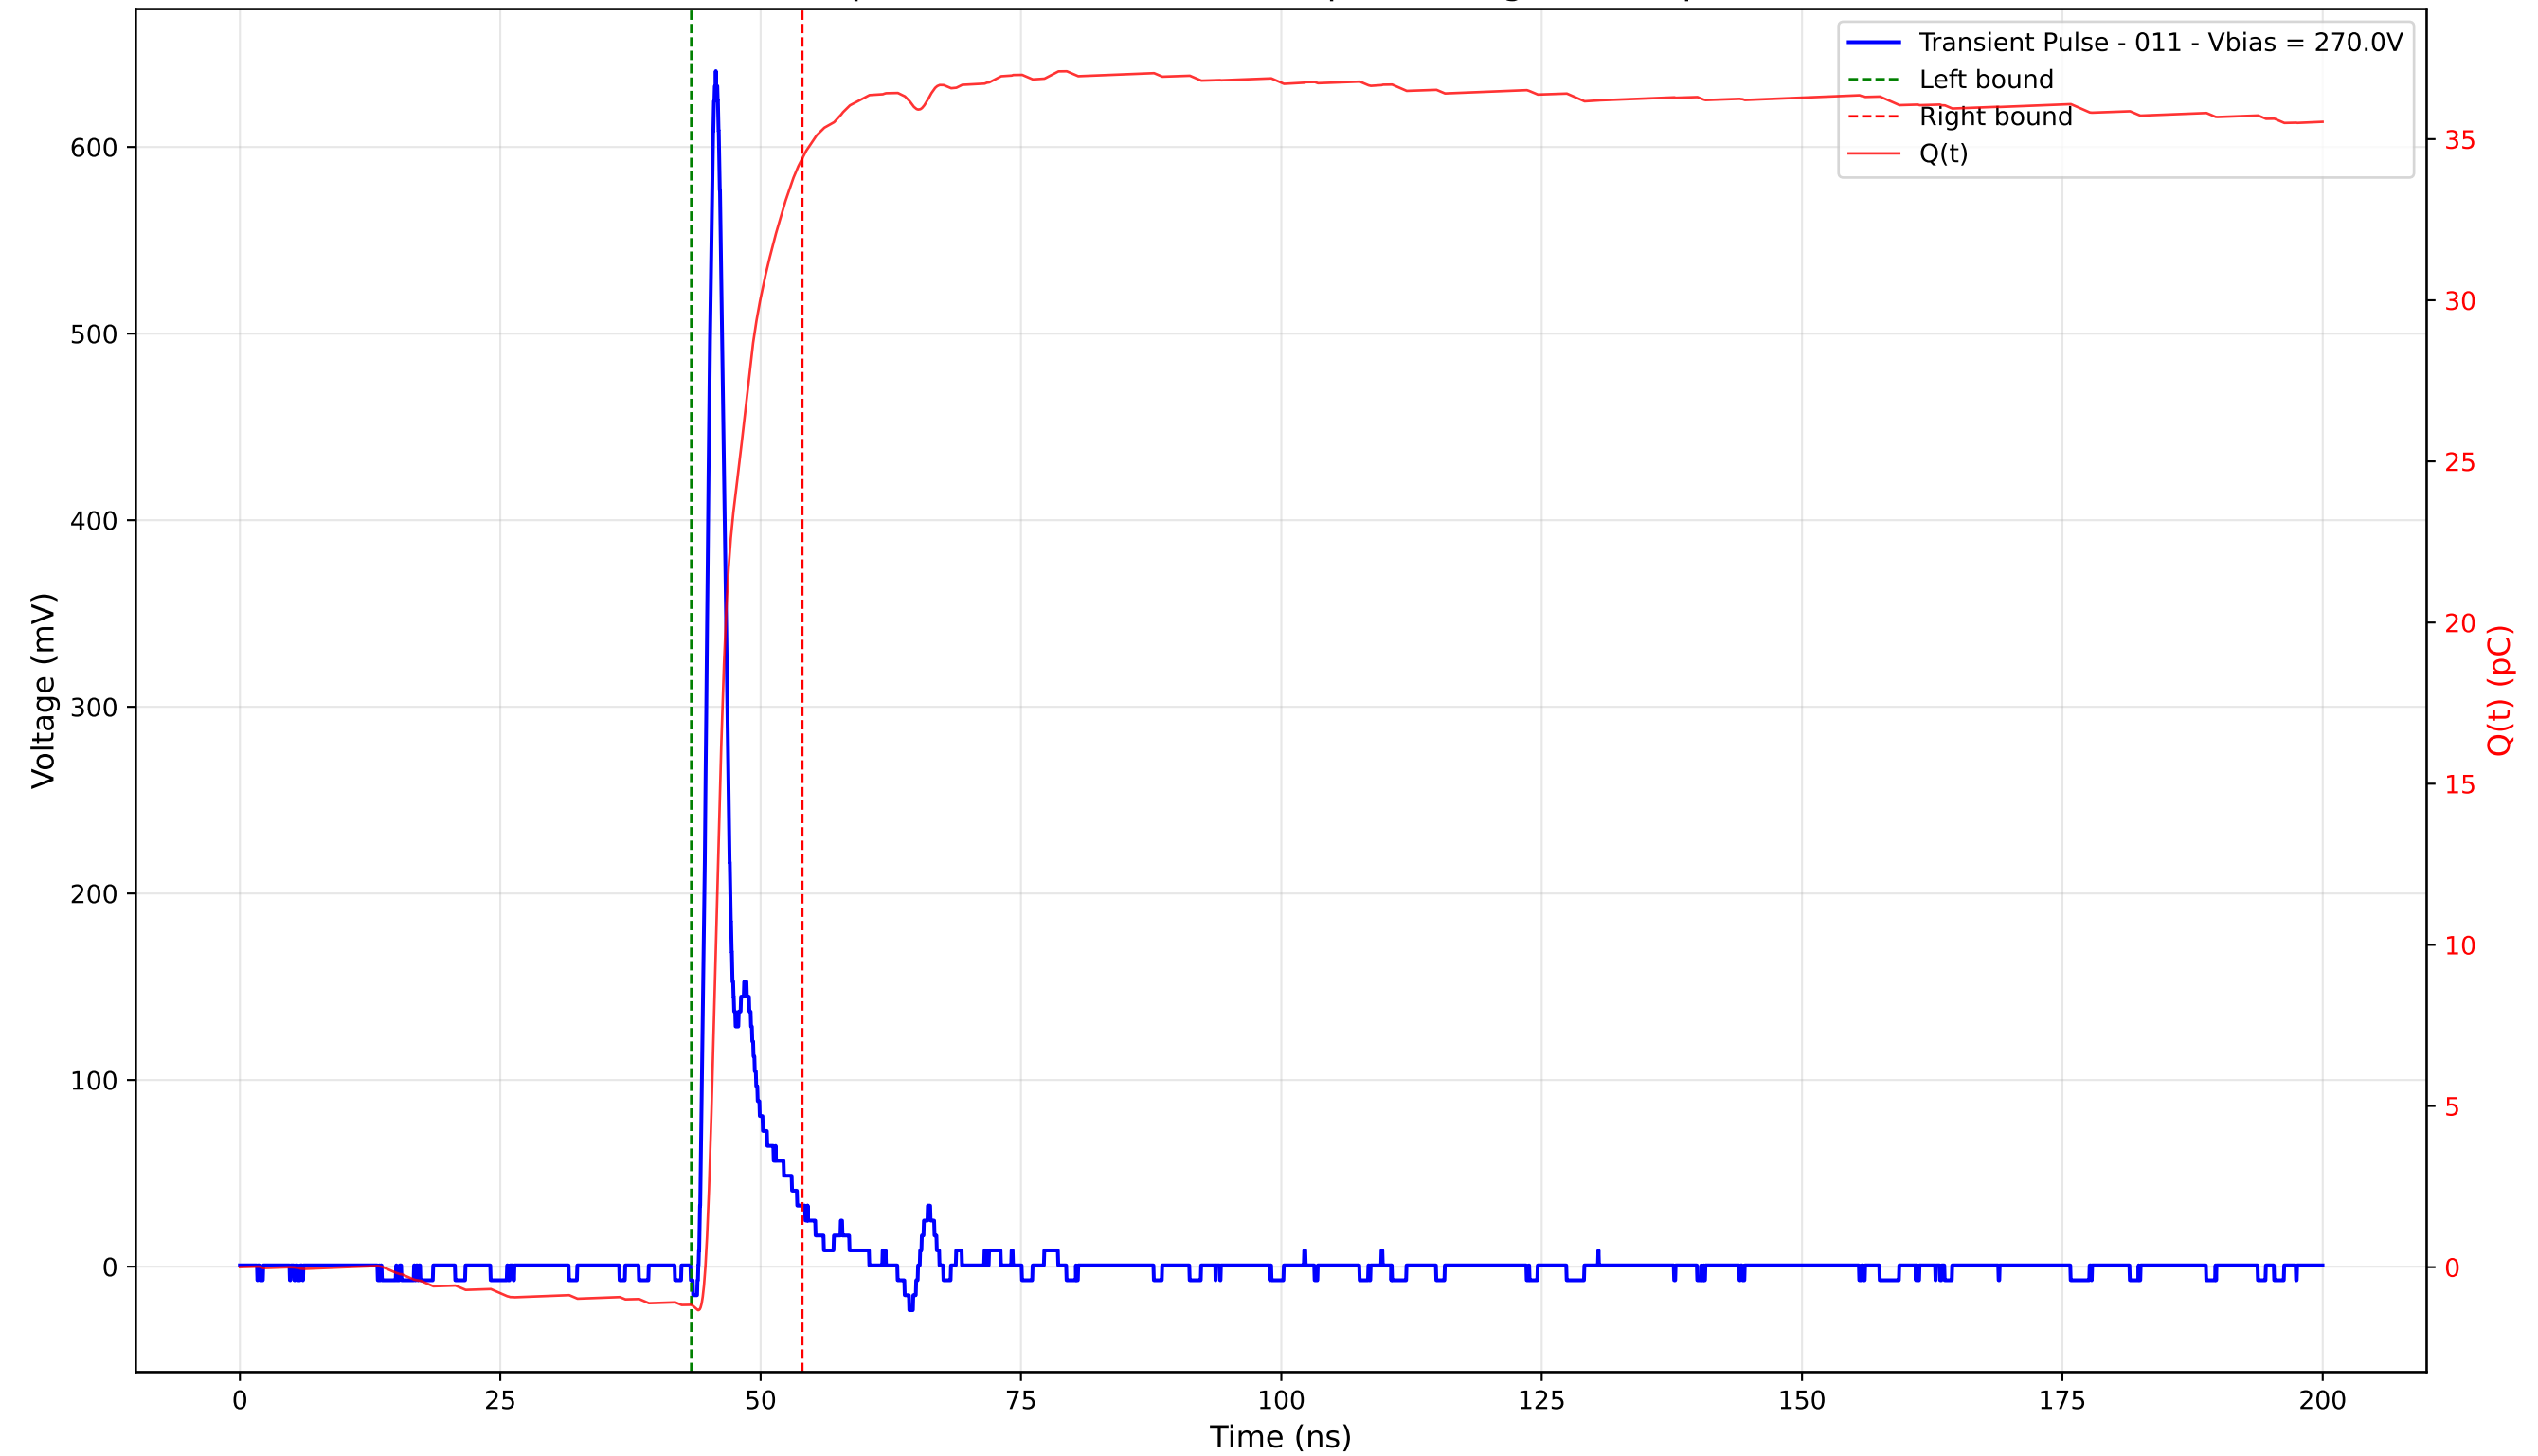


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 35.91 pC - Rise Time: 1.07 ns

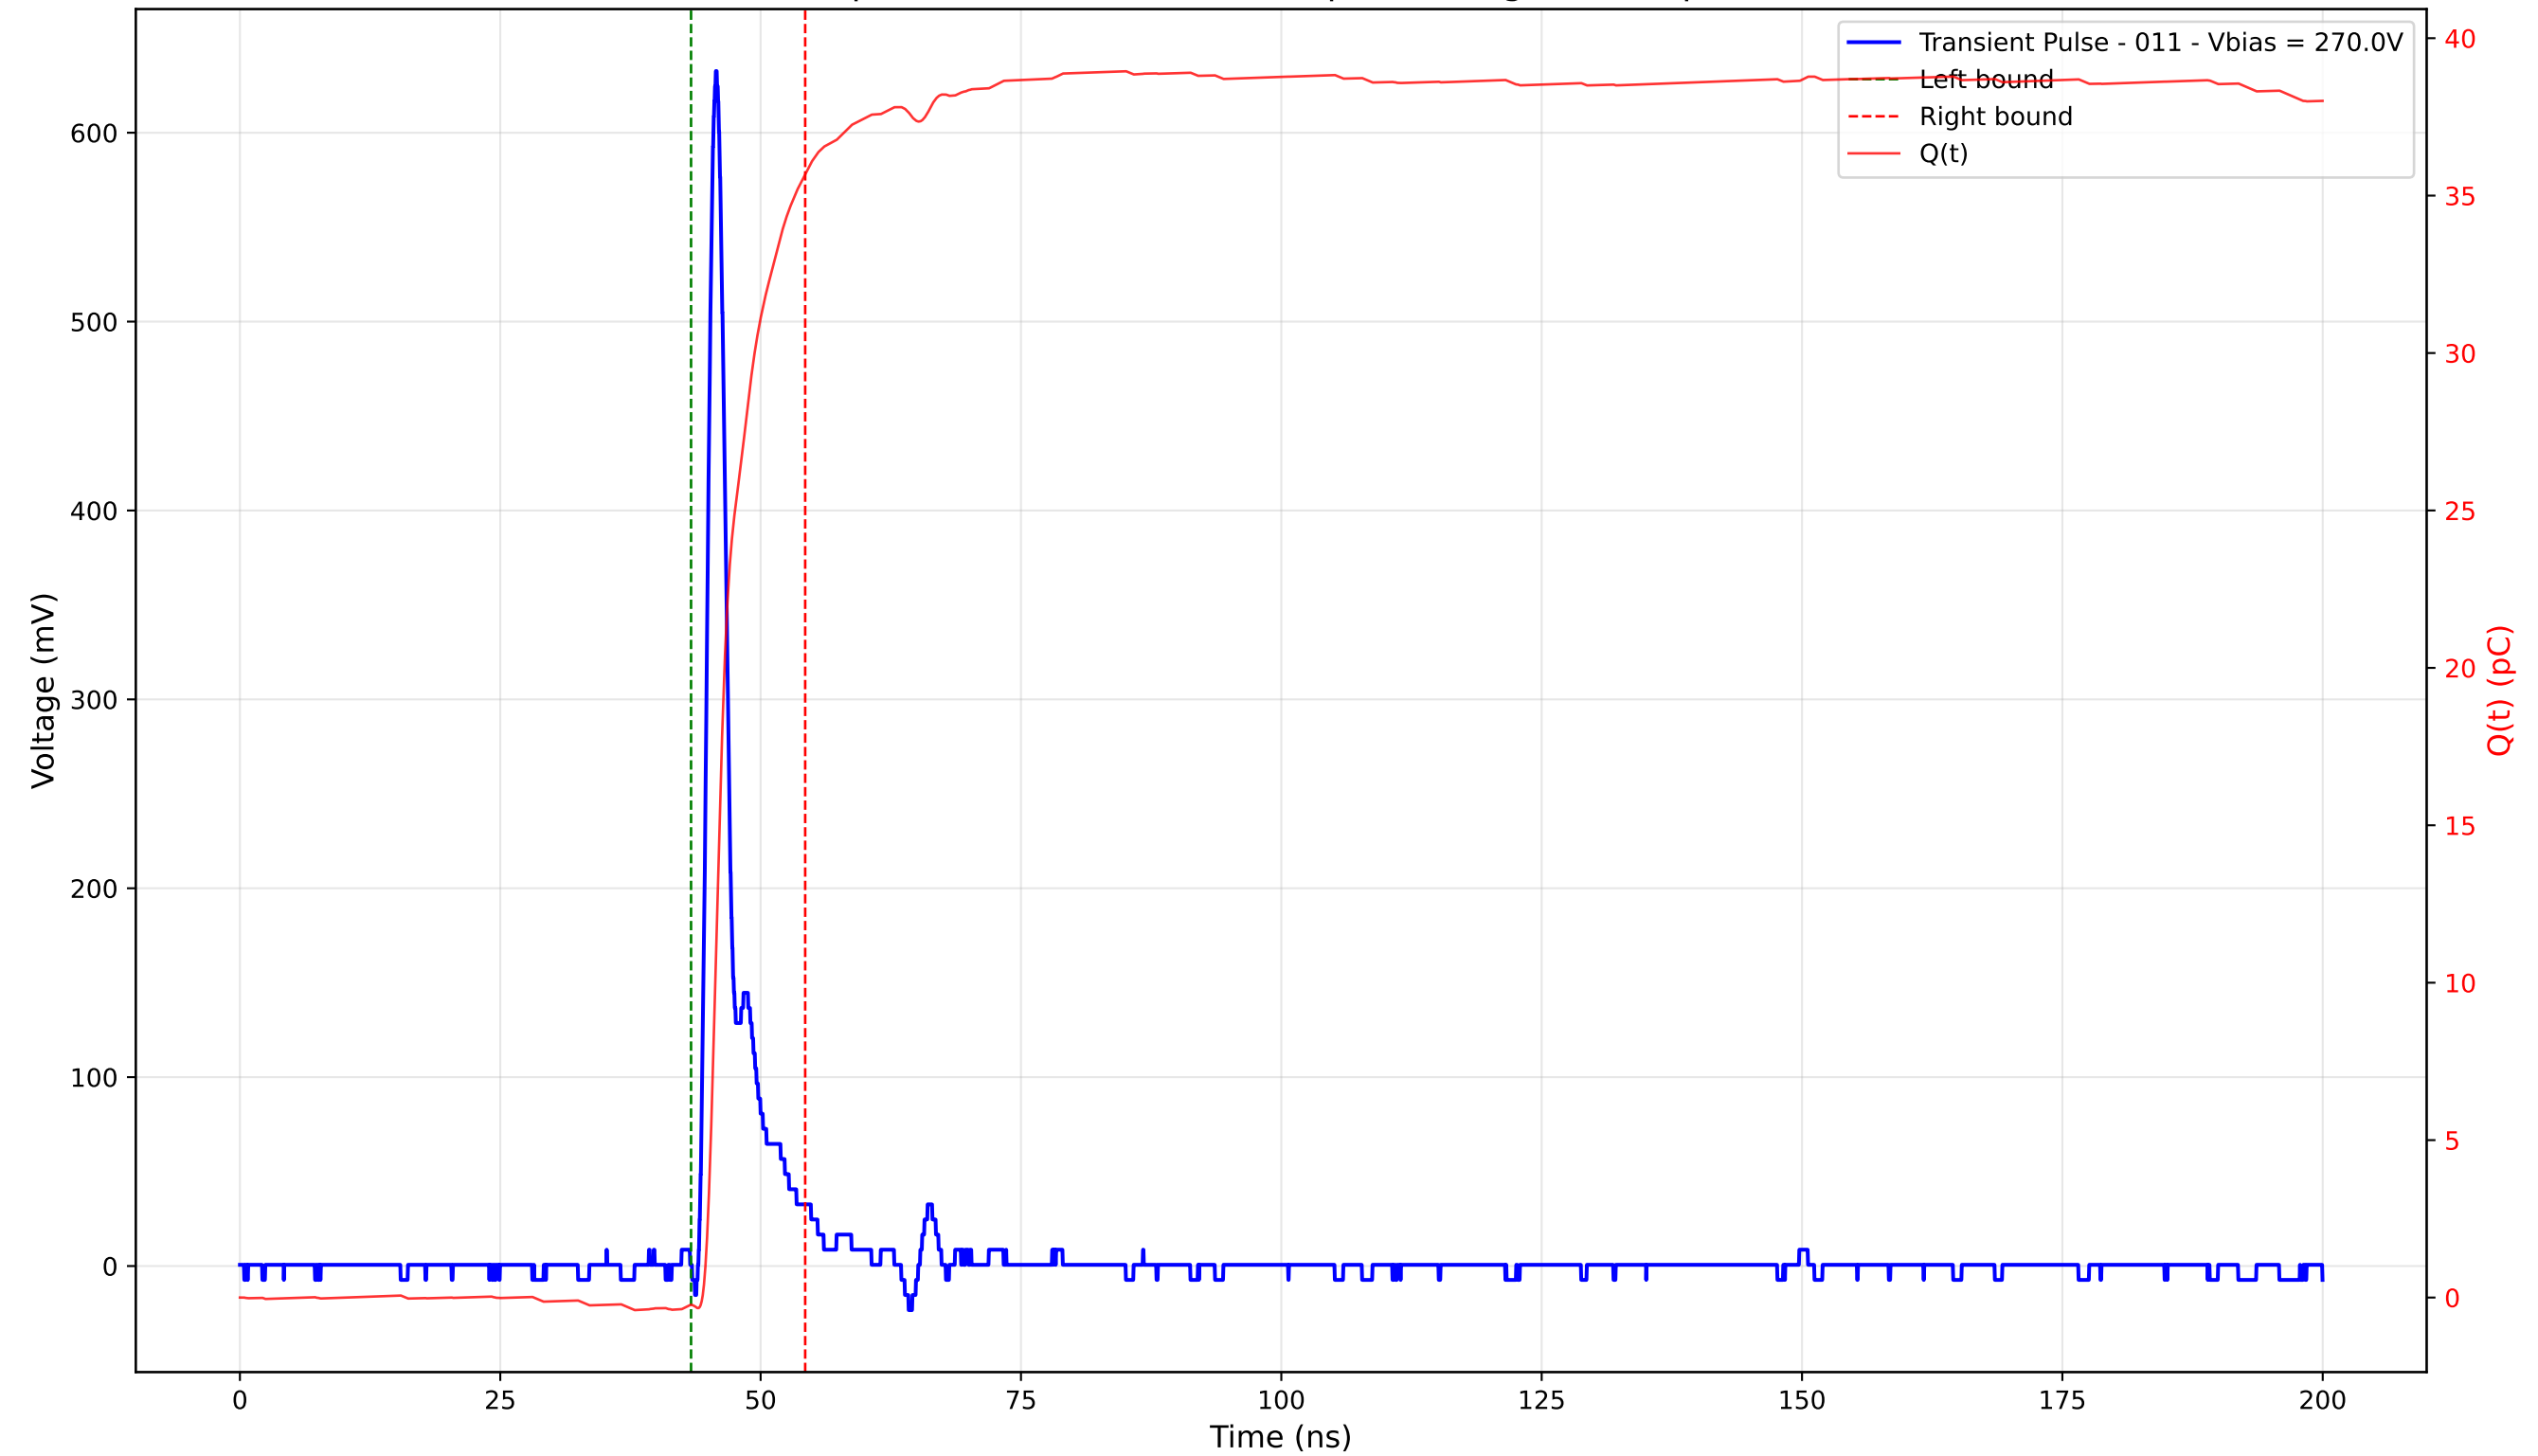


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 35.91 pC - Rise Time: 1.07 ns

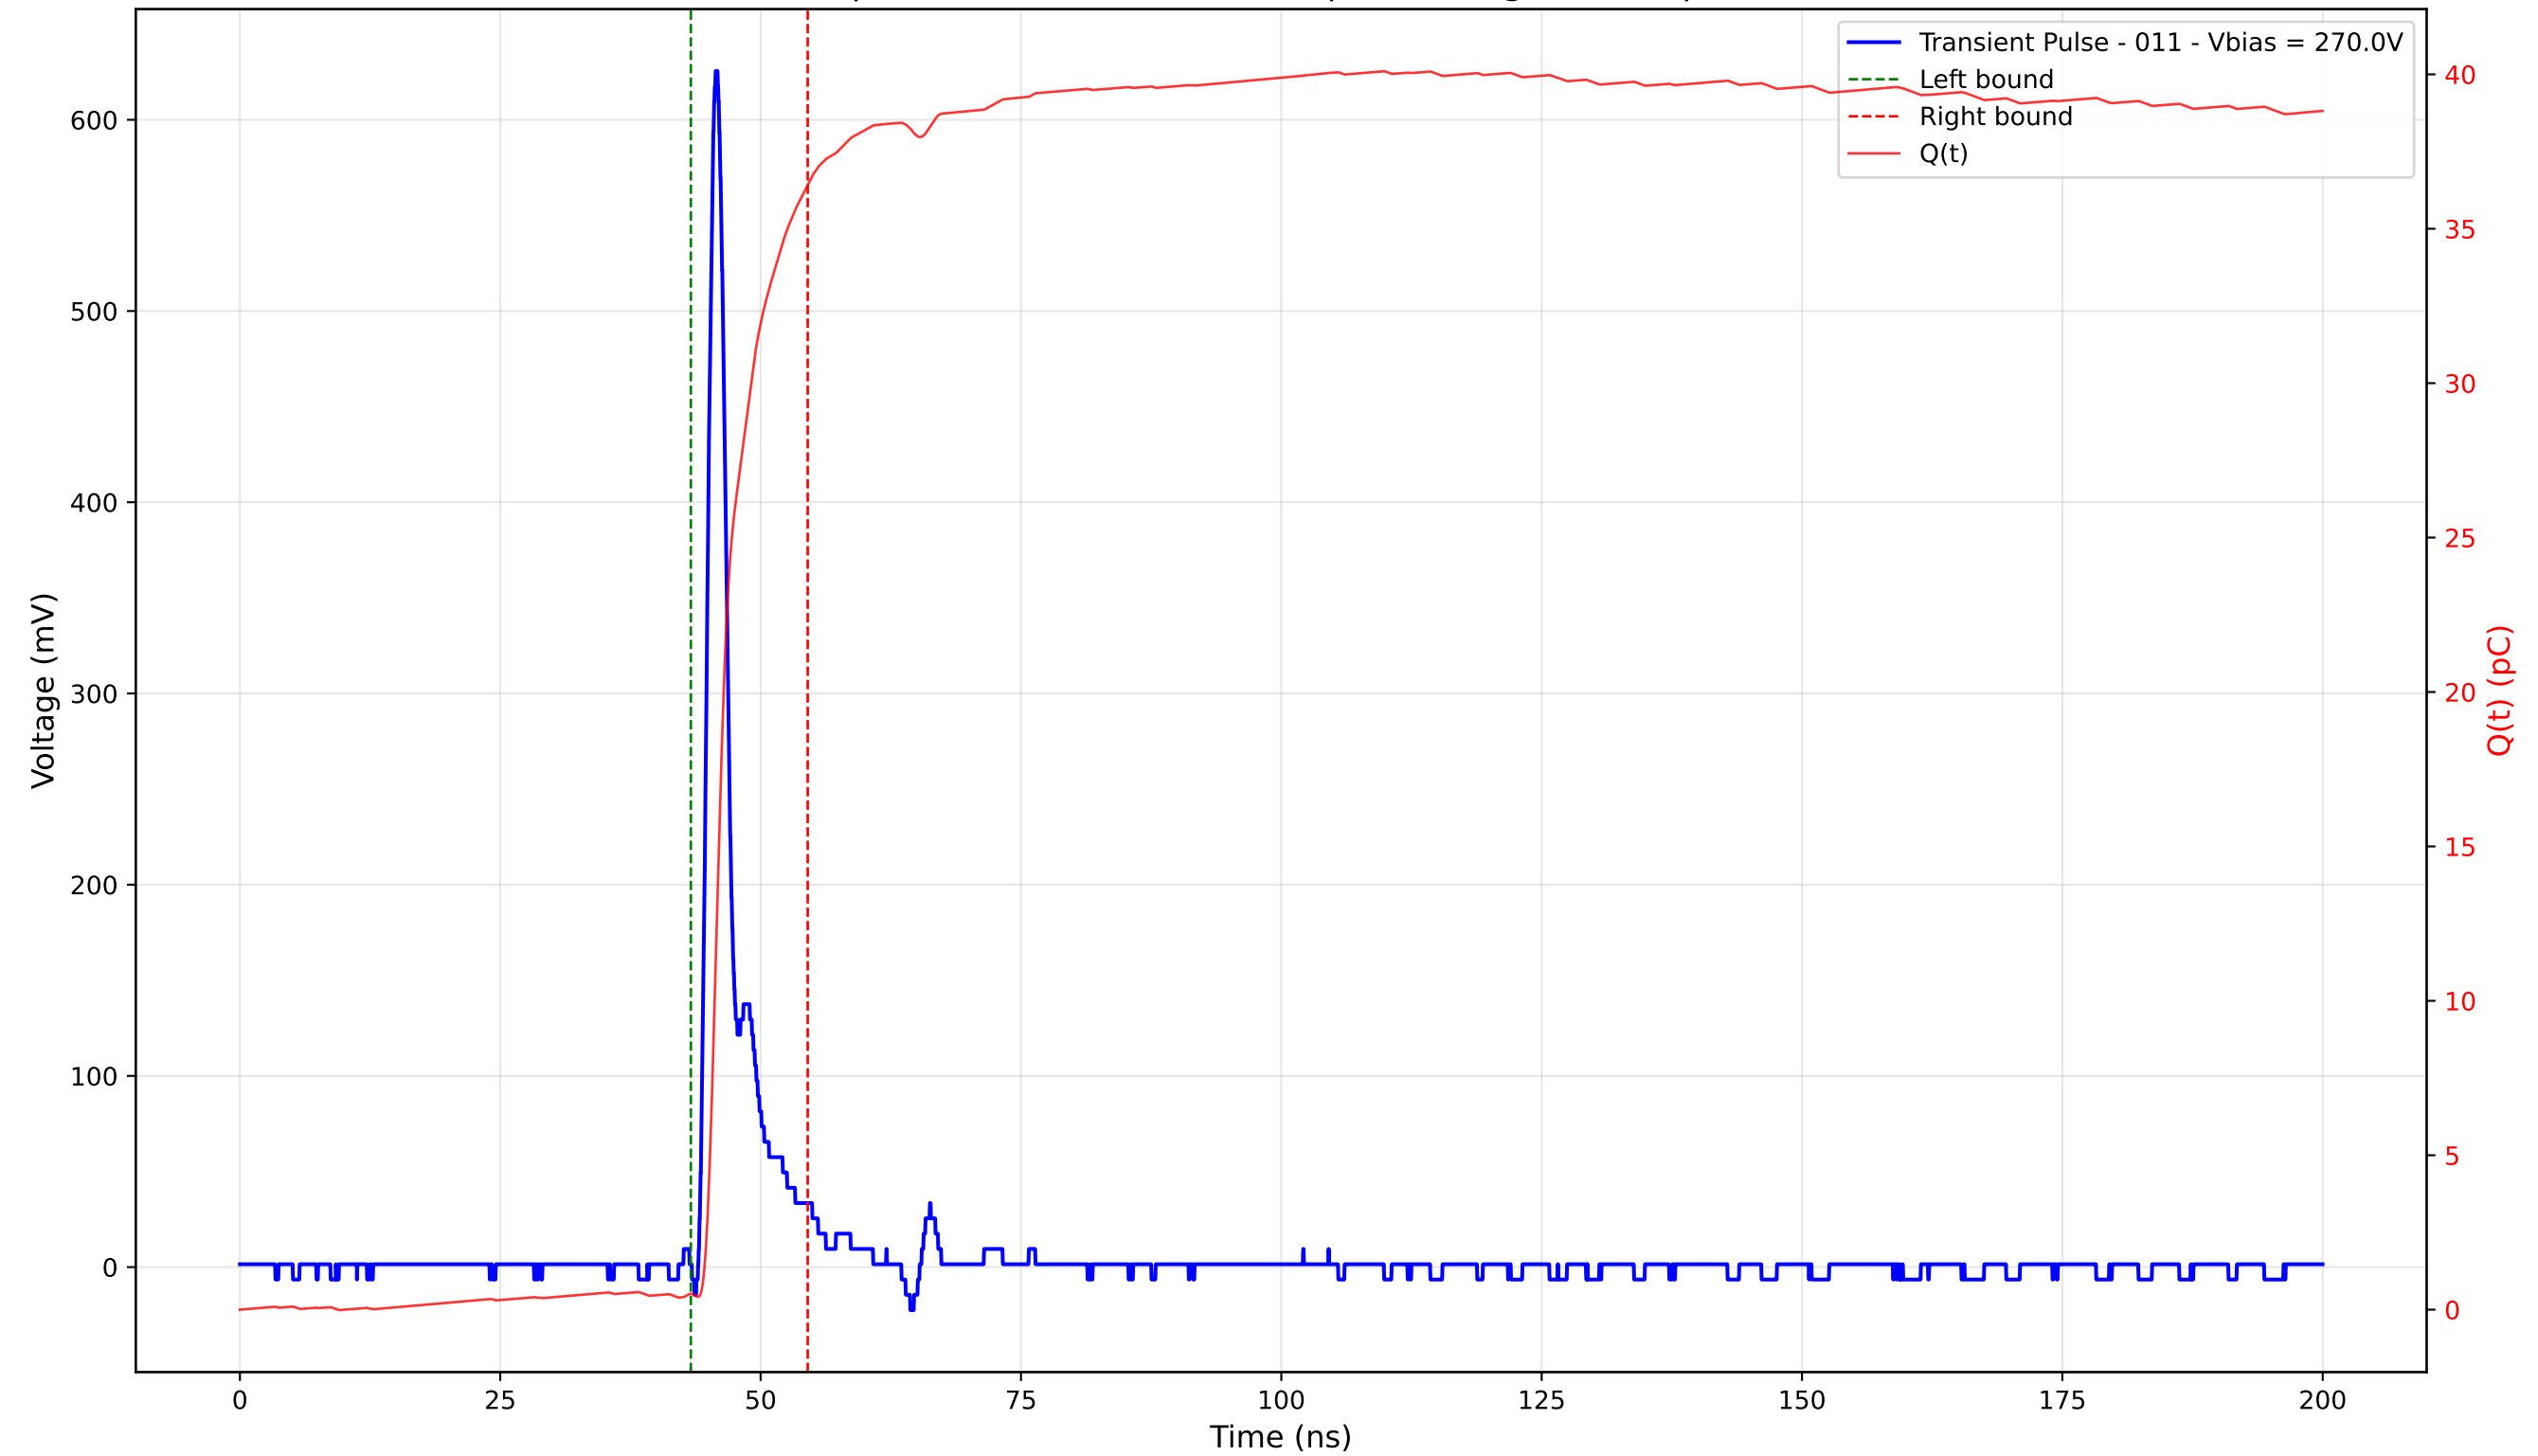


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 35.11 pC - Rise Time: 1.06 ns

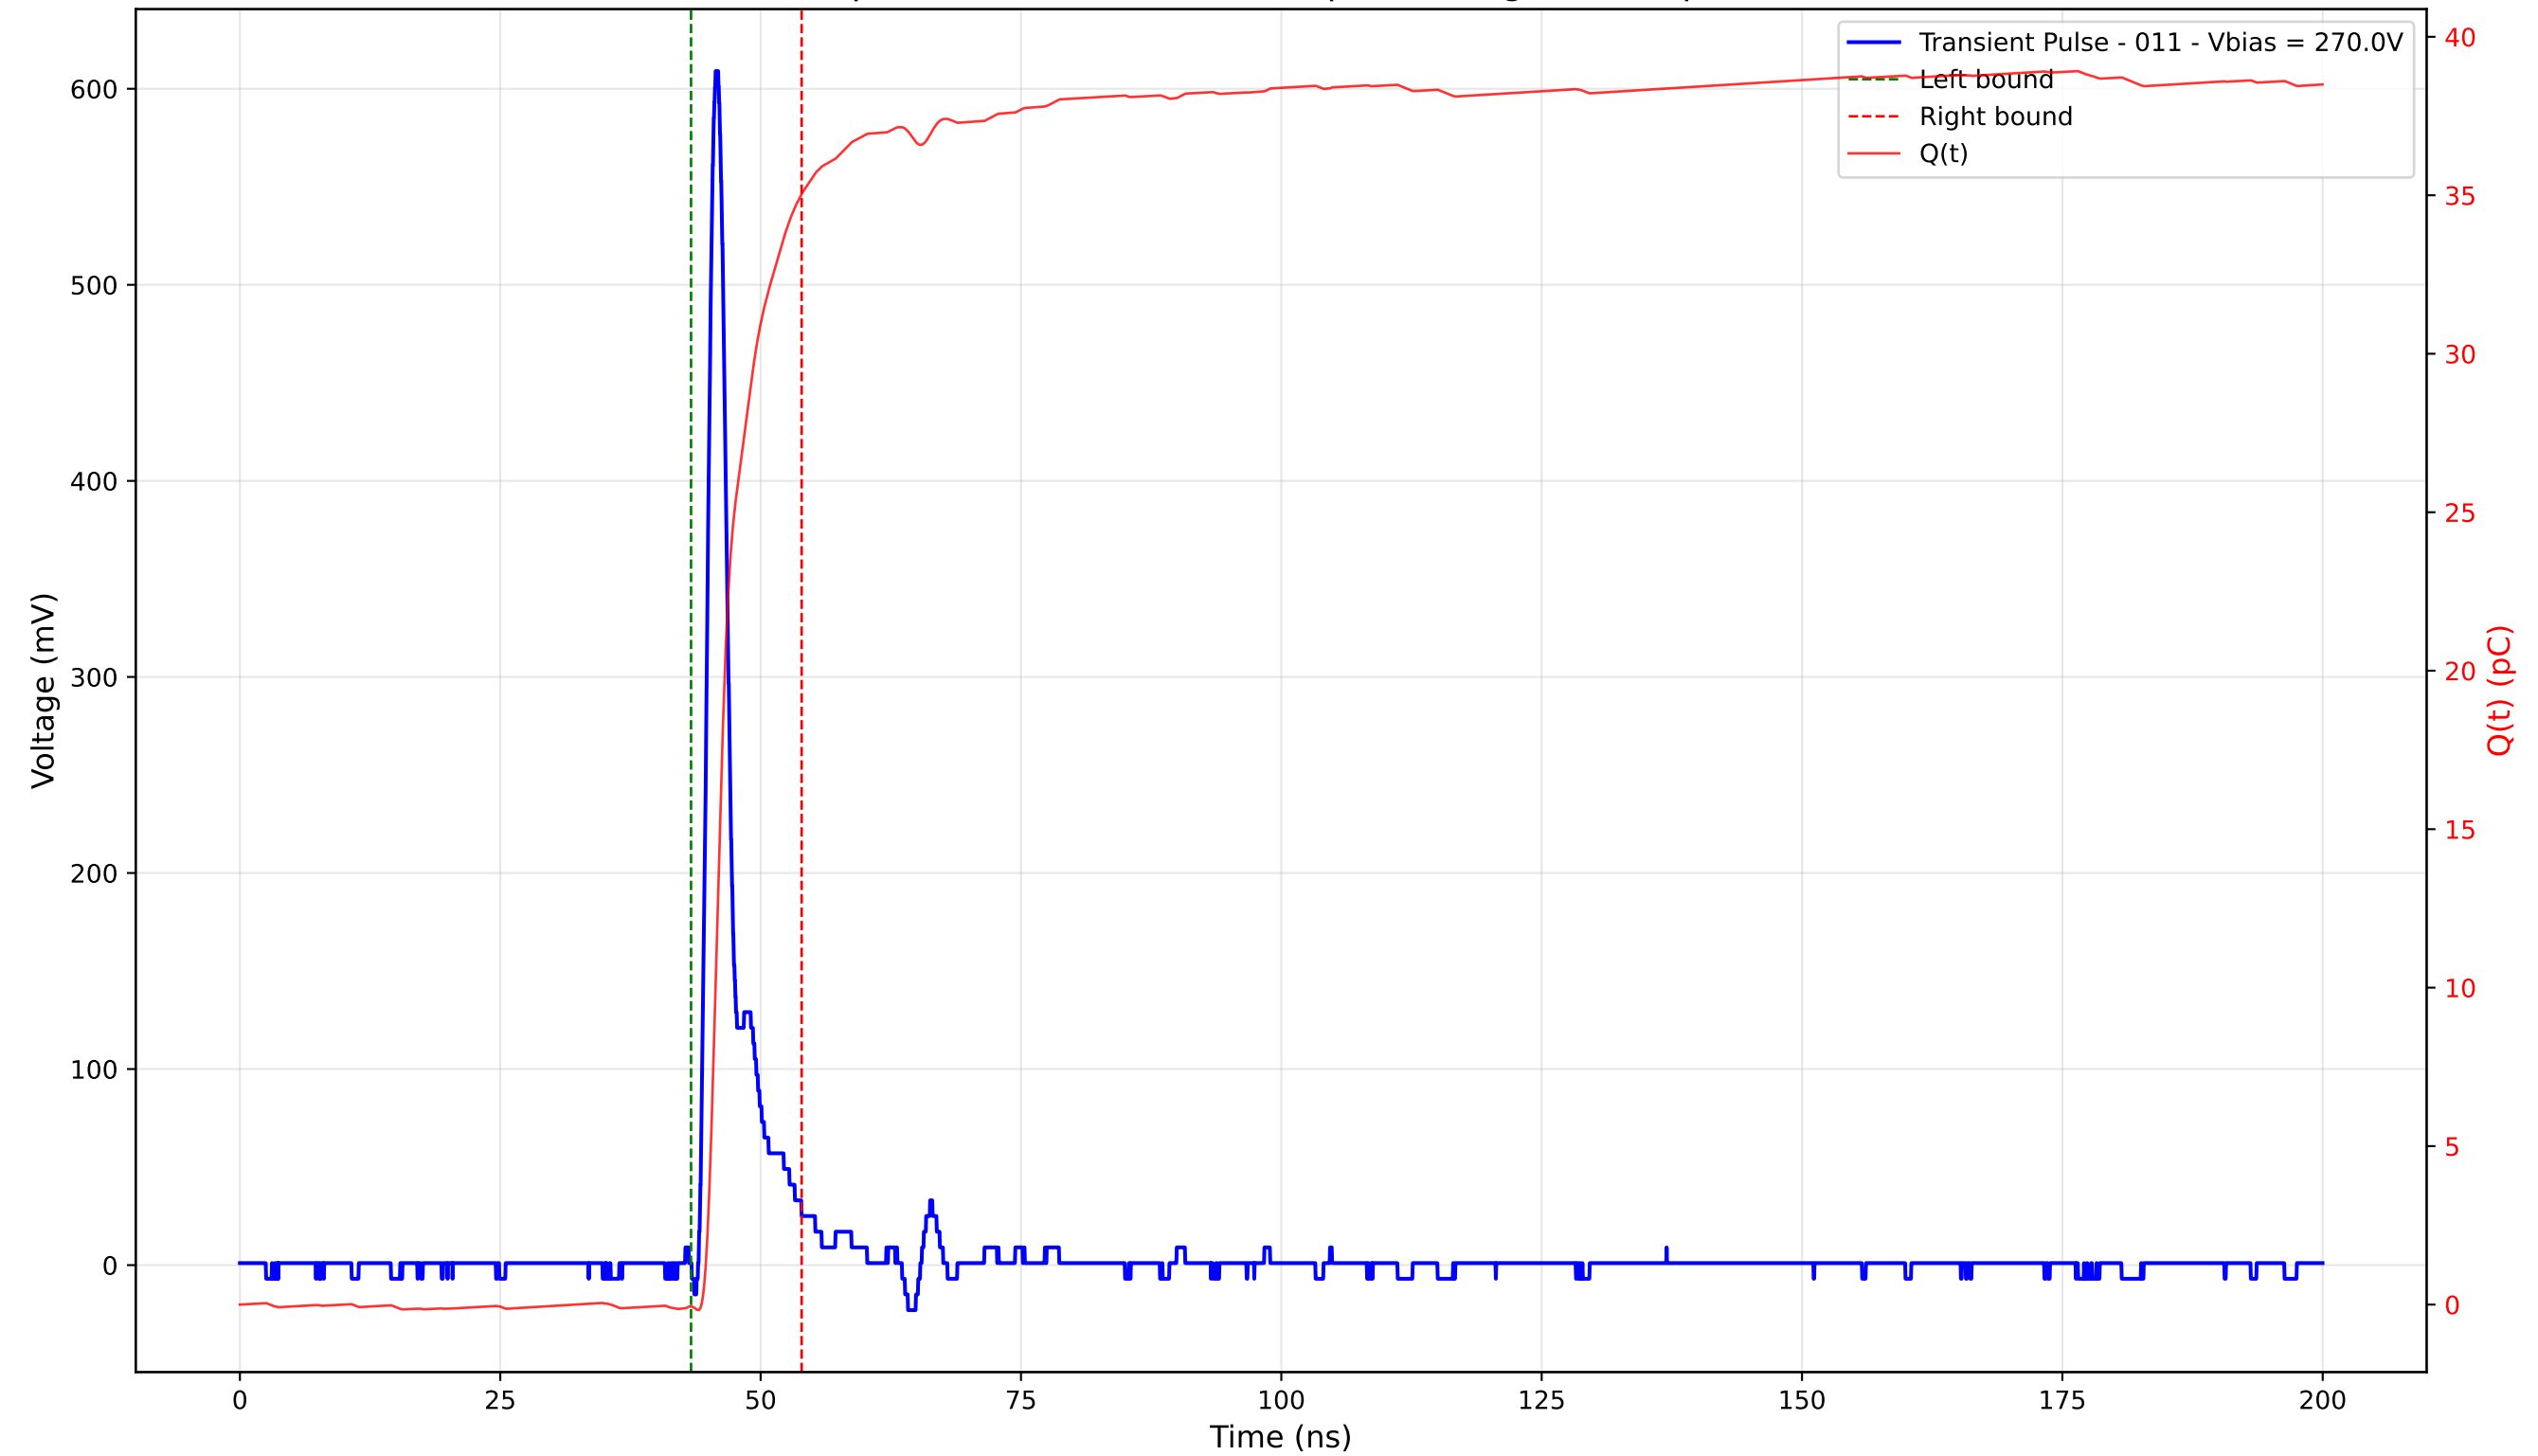


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 35.27 pC - Rise Time: 1.08 ns

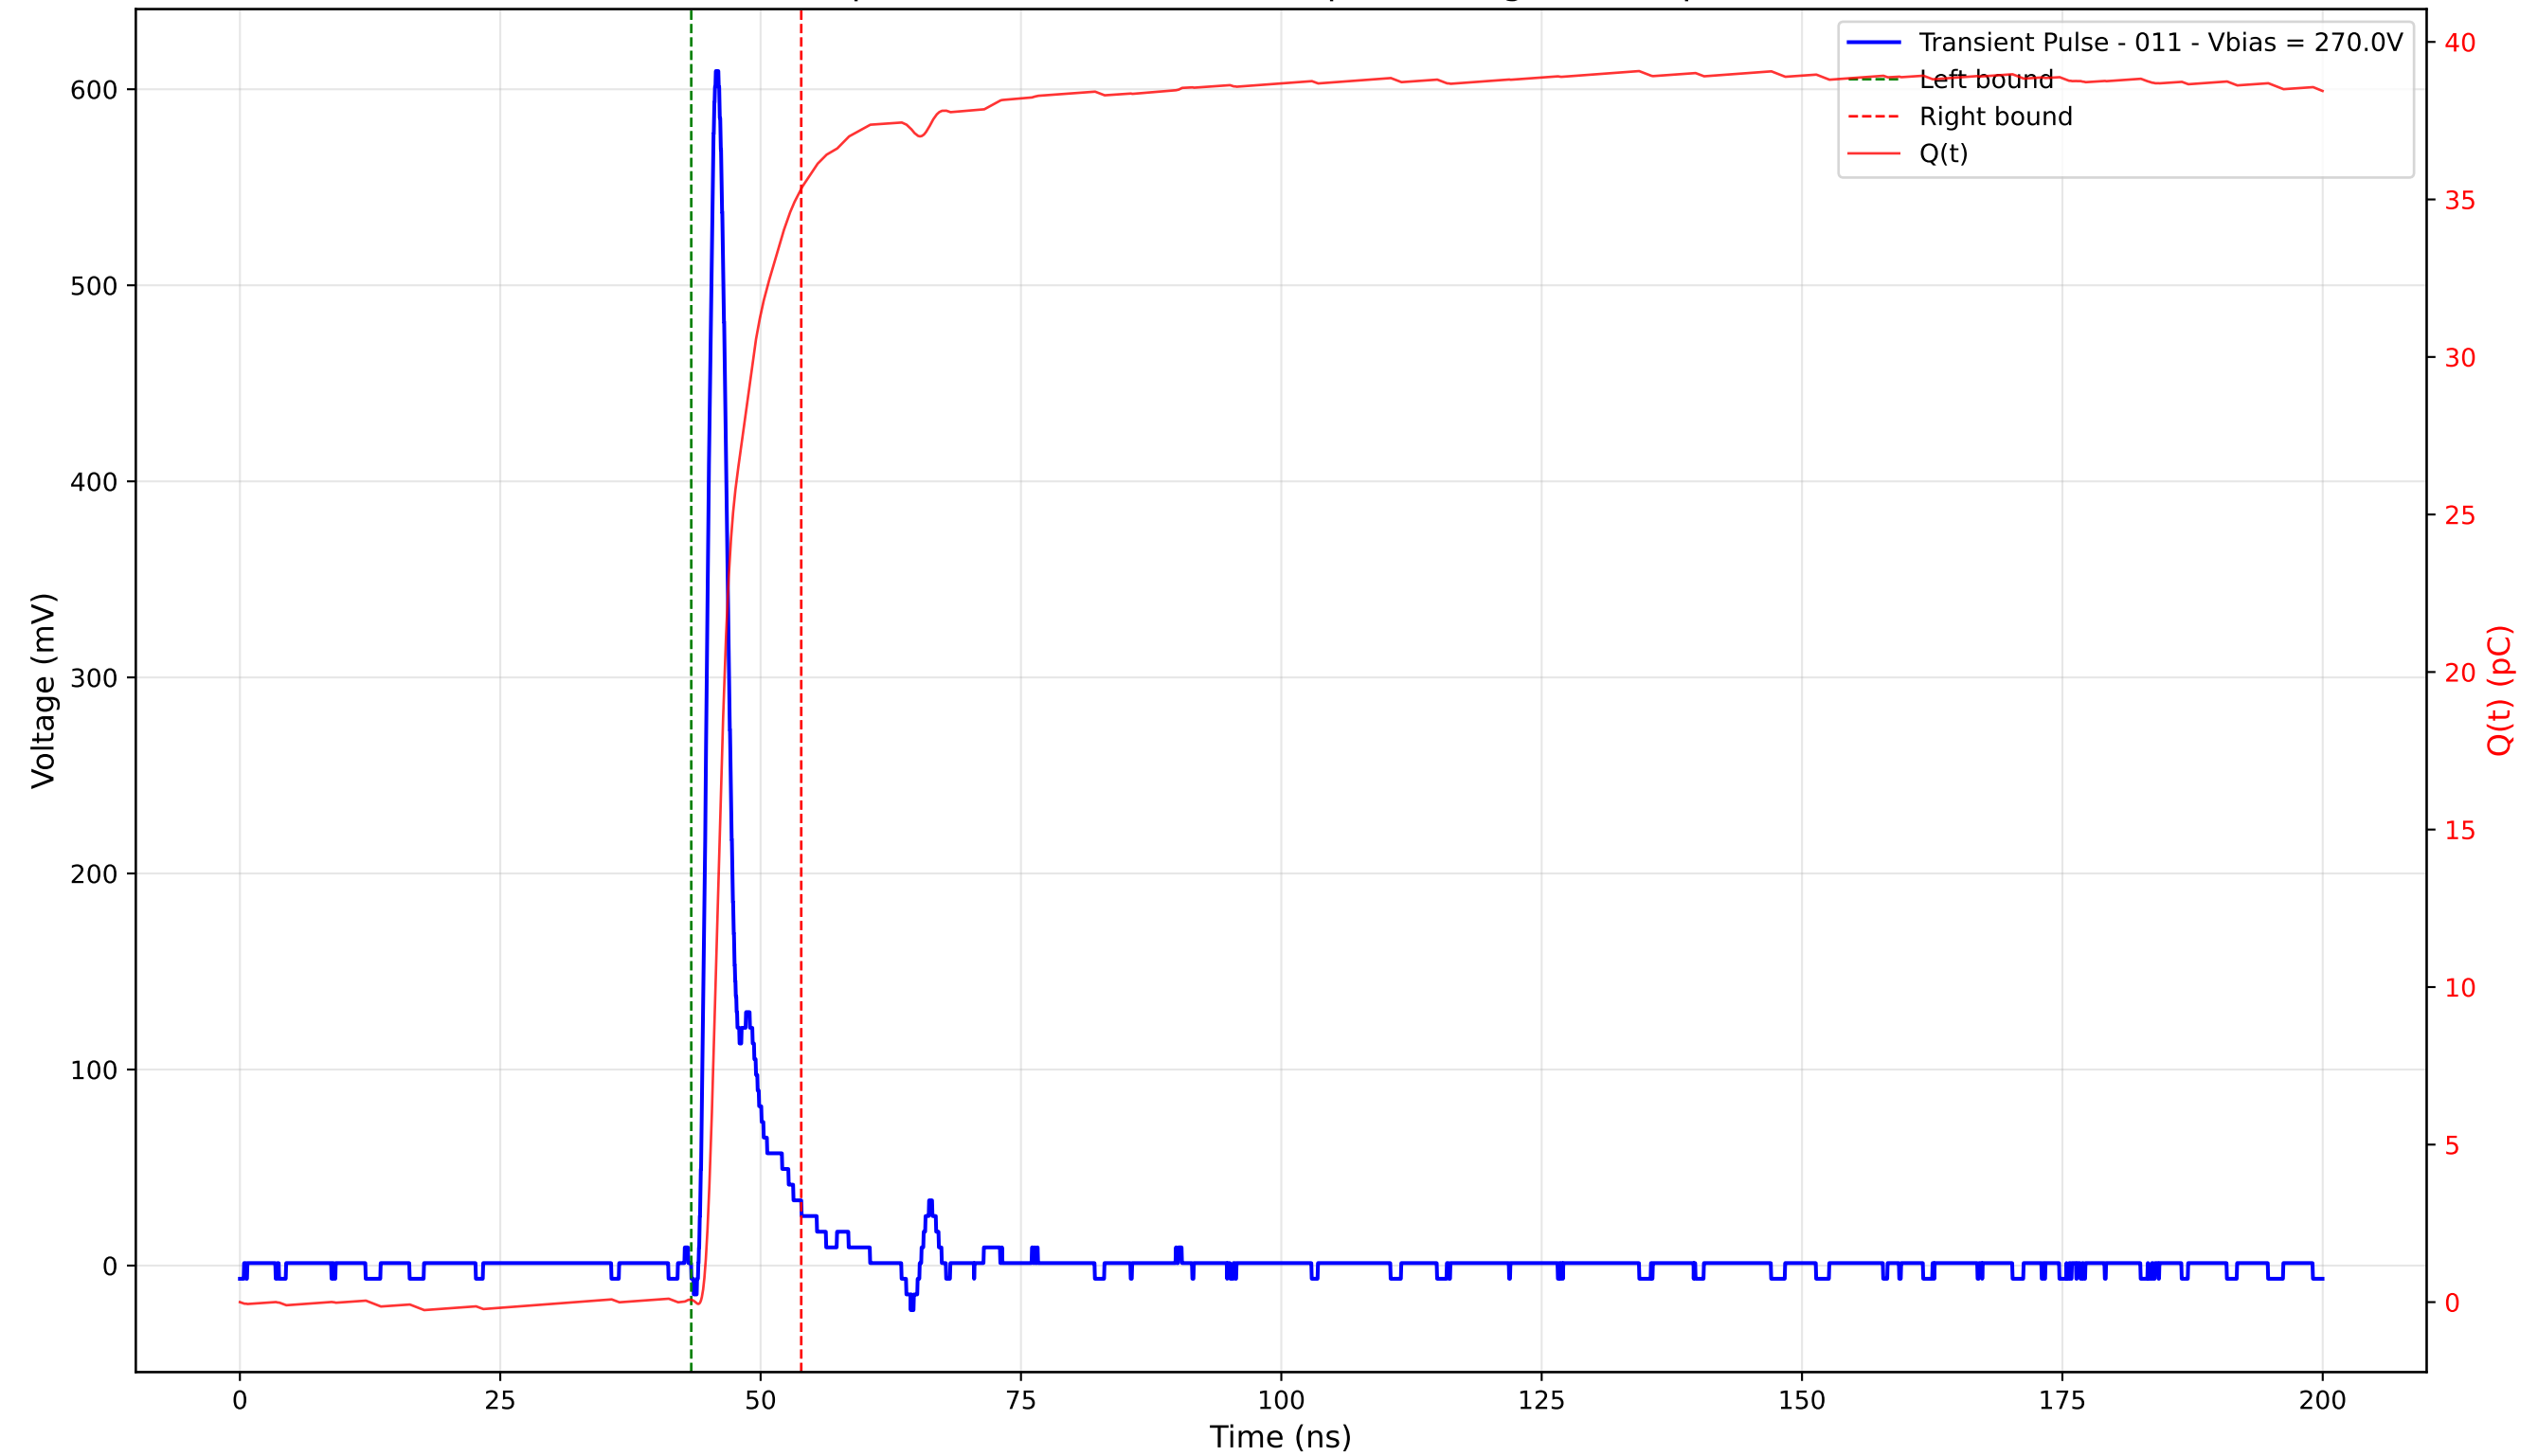


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 35.13 pC - Rise Time: 1.08 ns

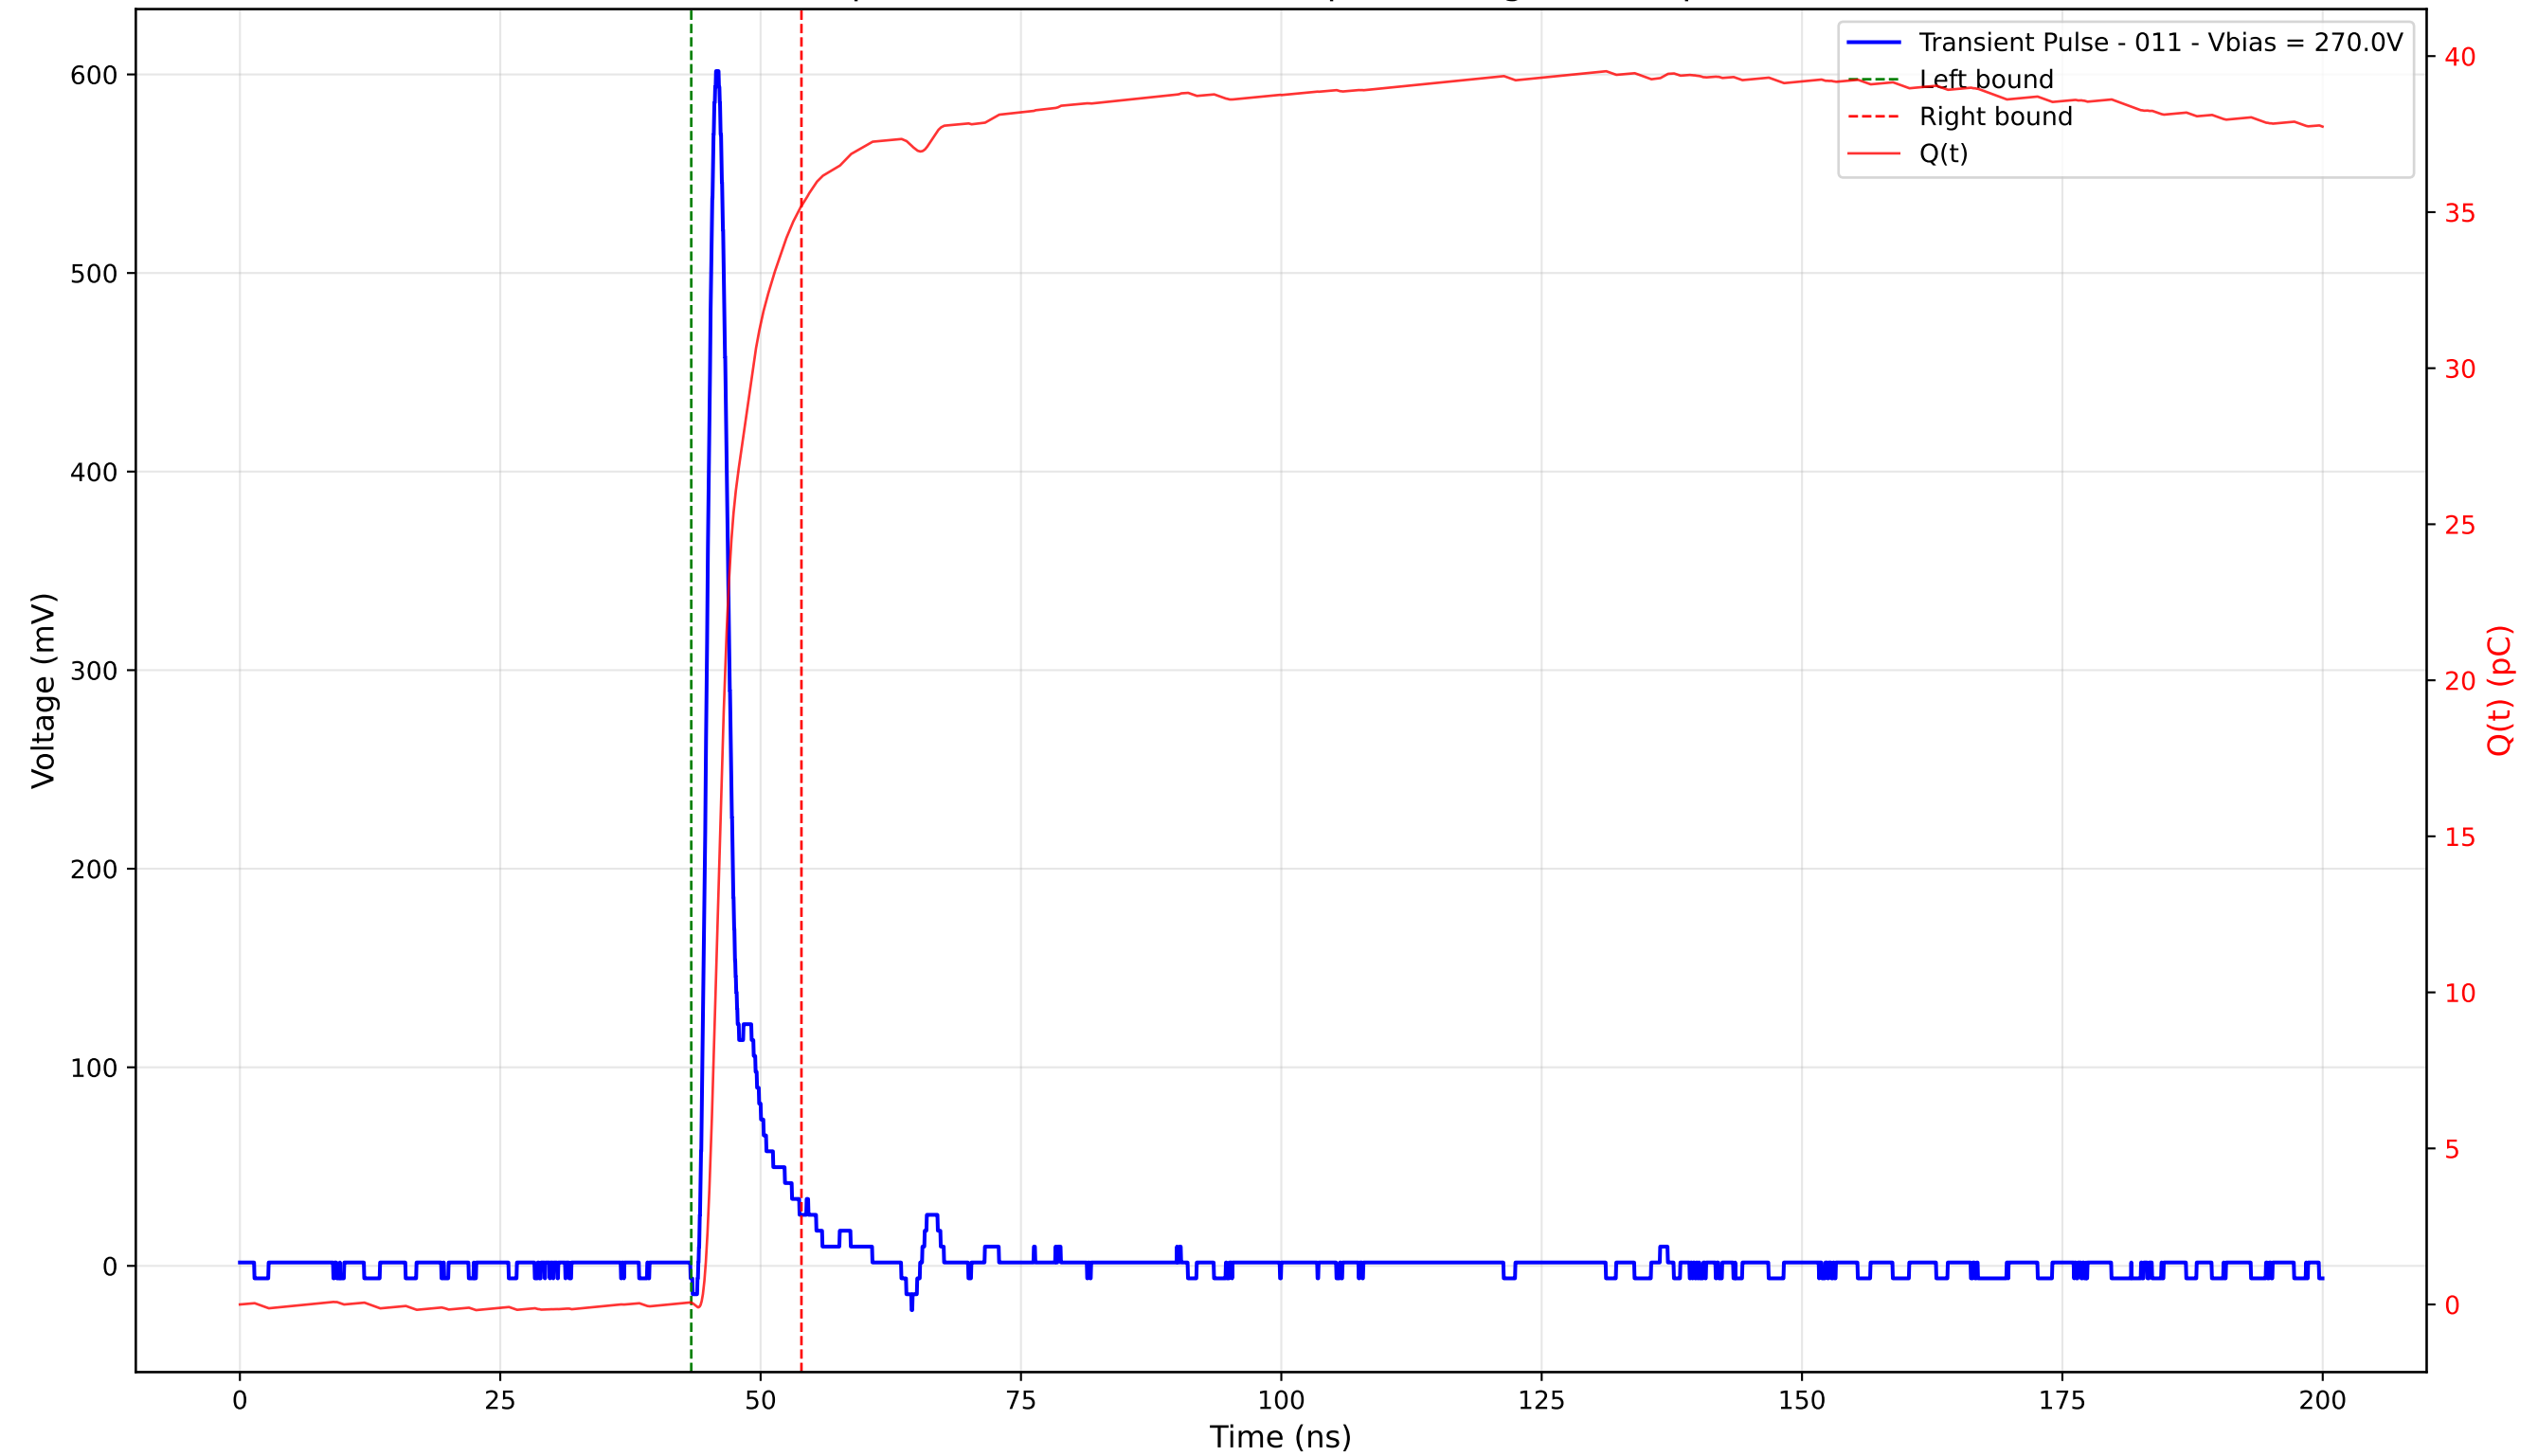


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 35.39 pC - Rise Time: 1.09 ns

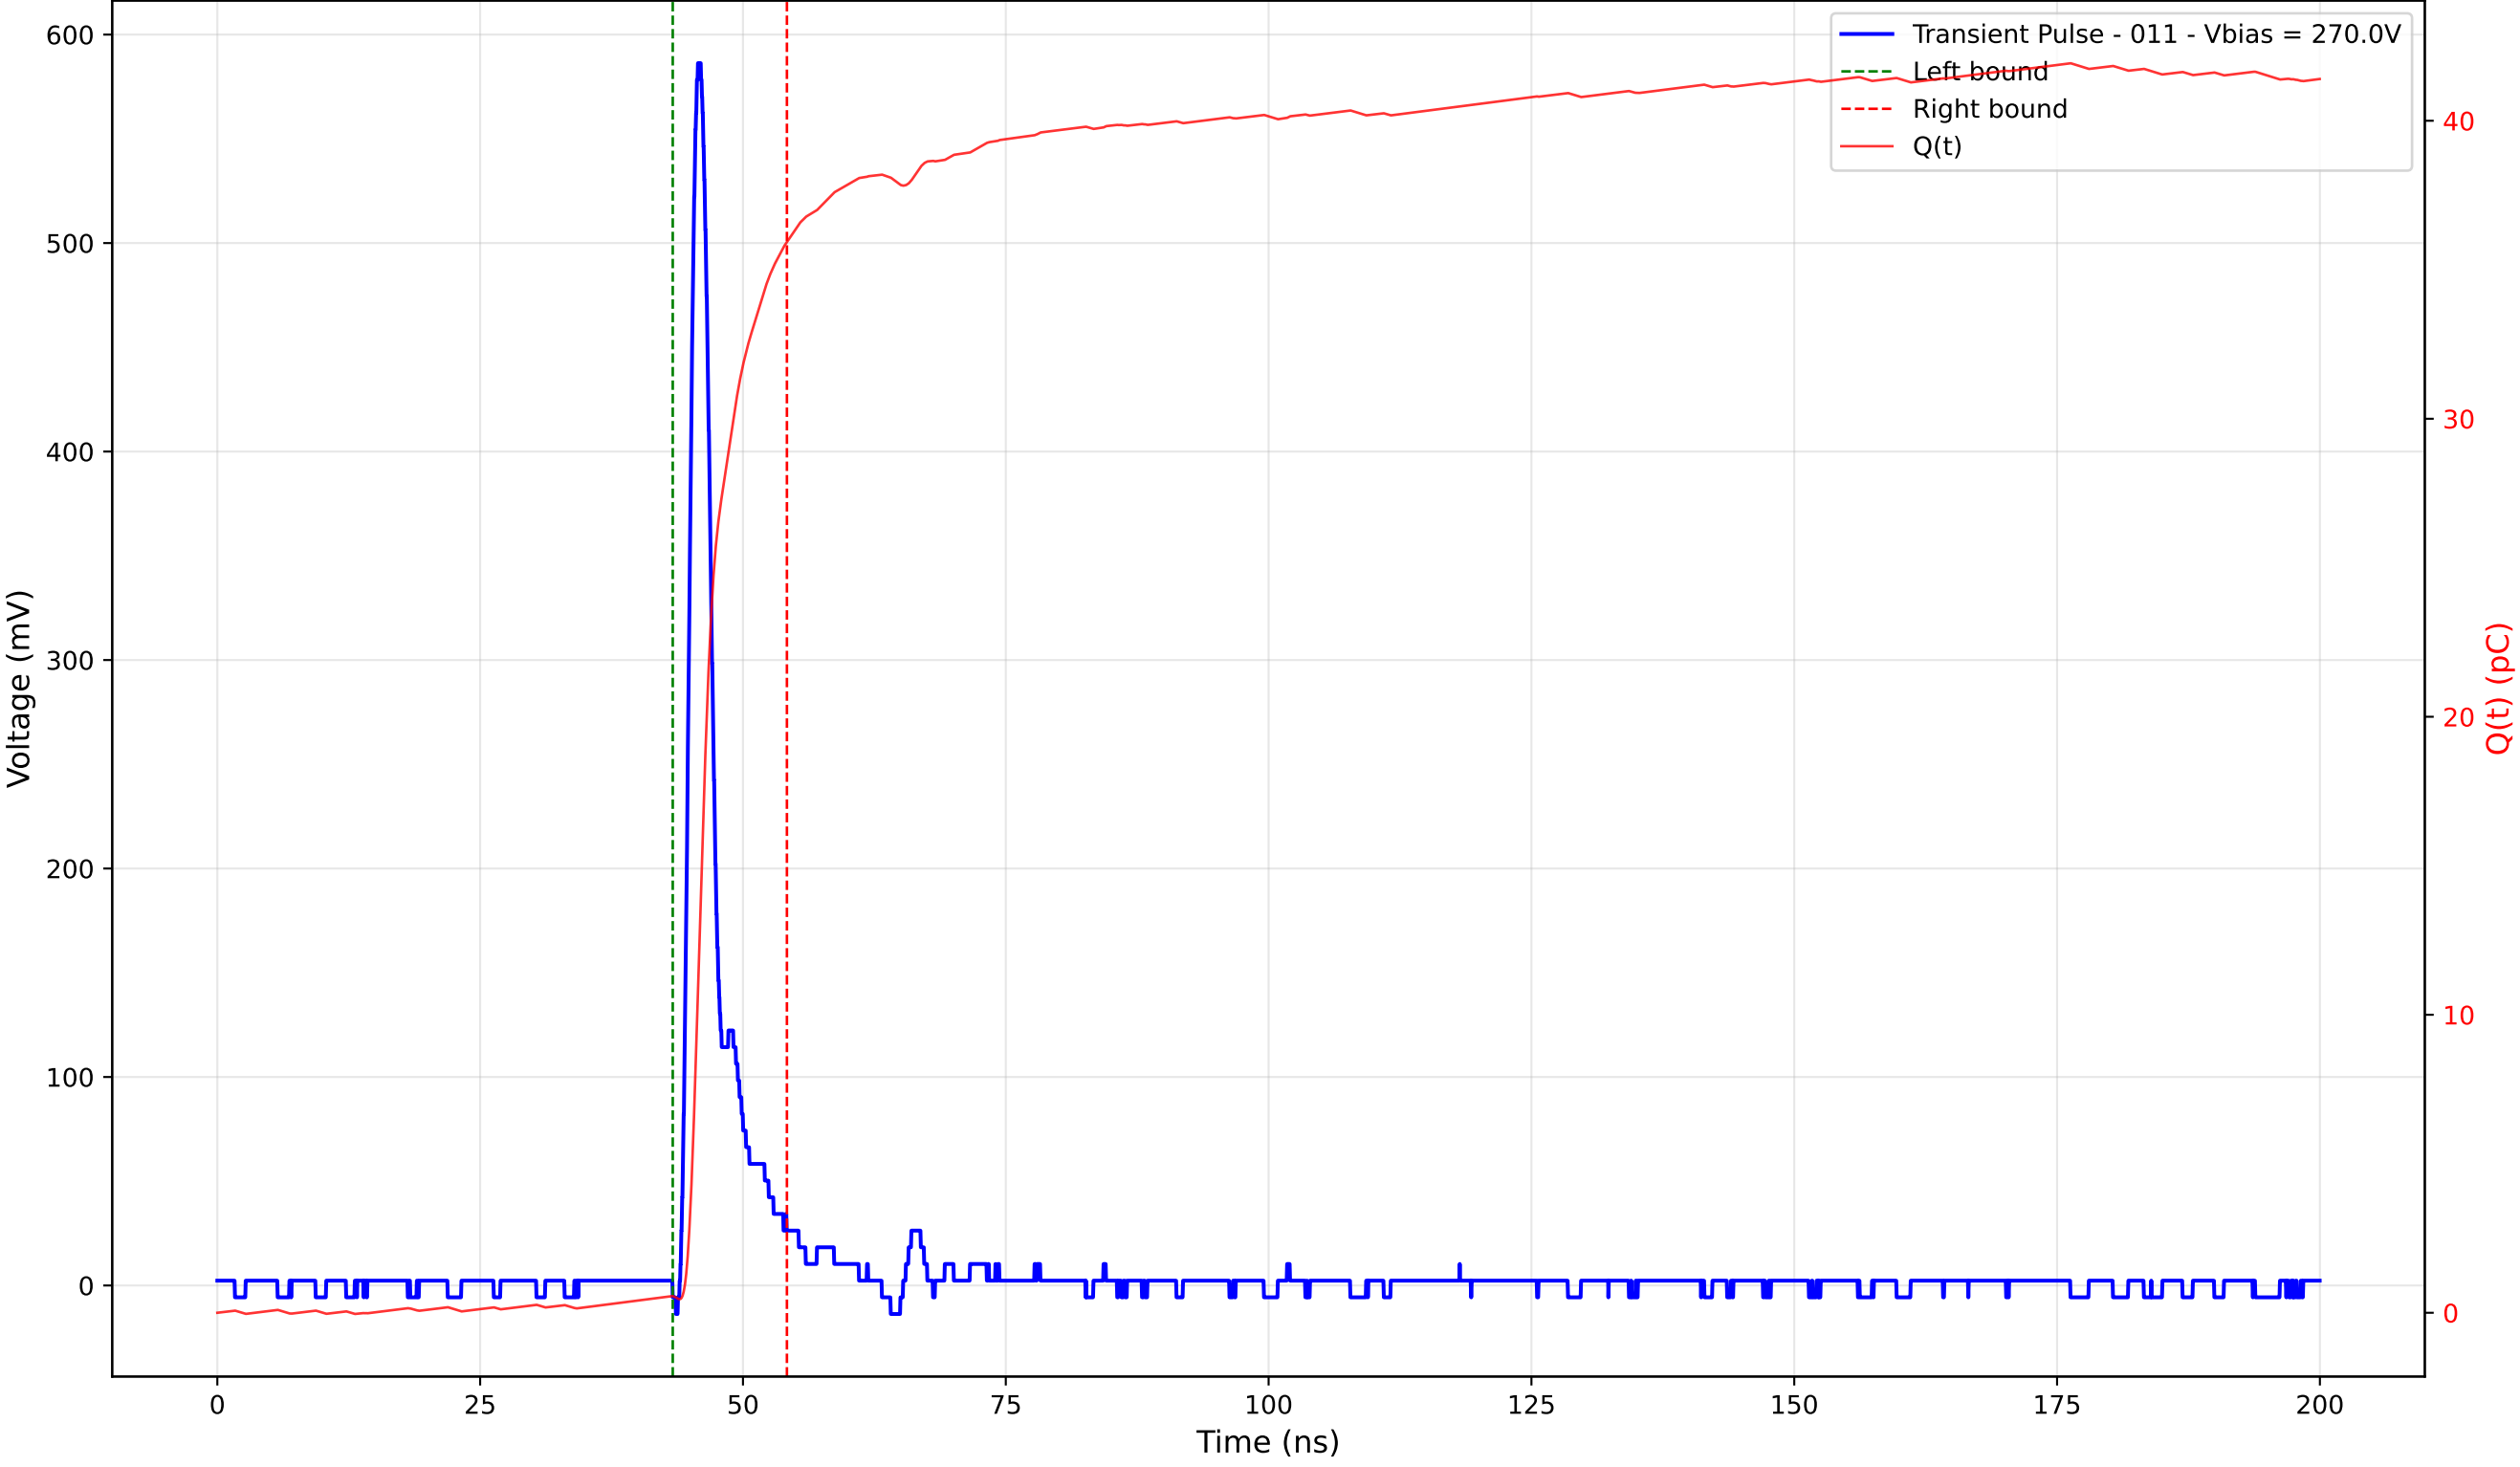


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 34.57 pC - Rise Time: 1.10 ns

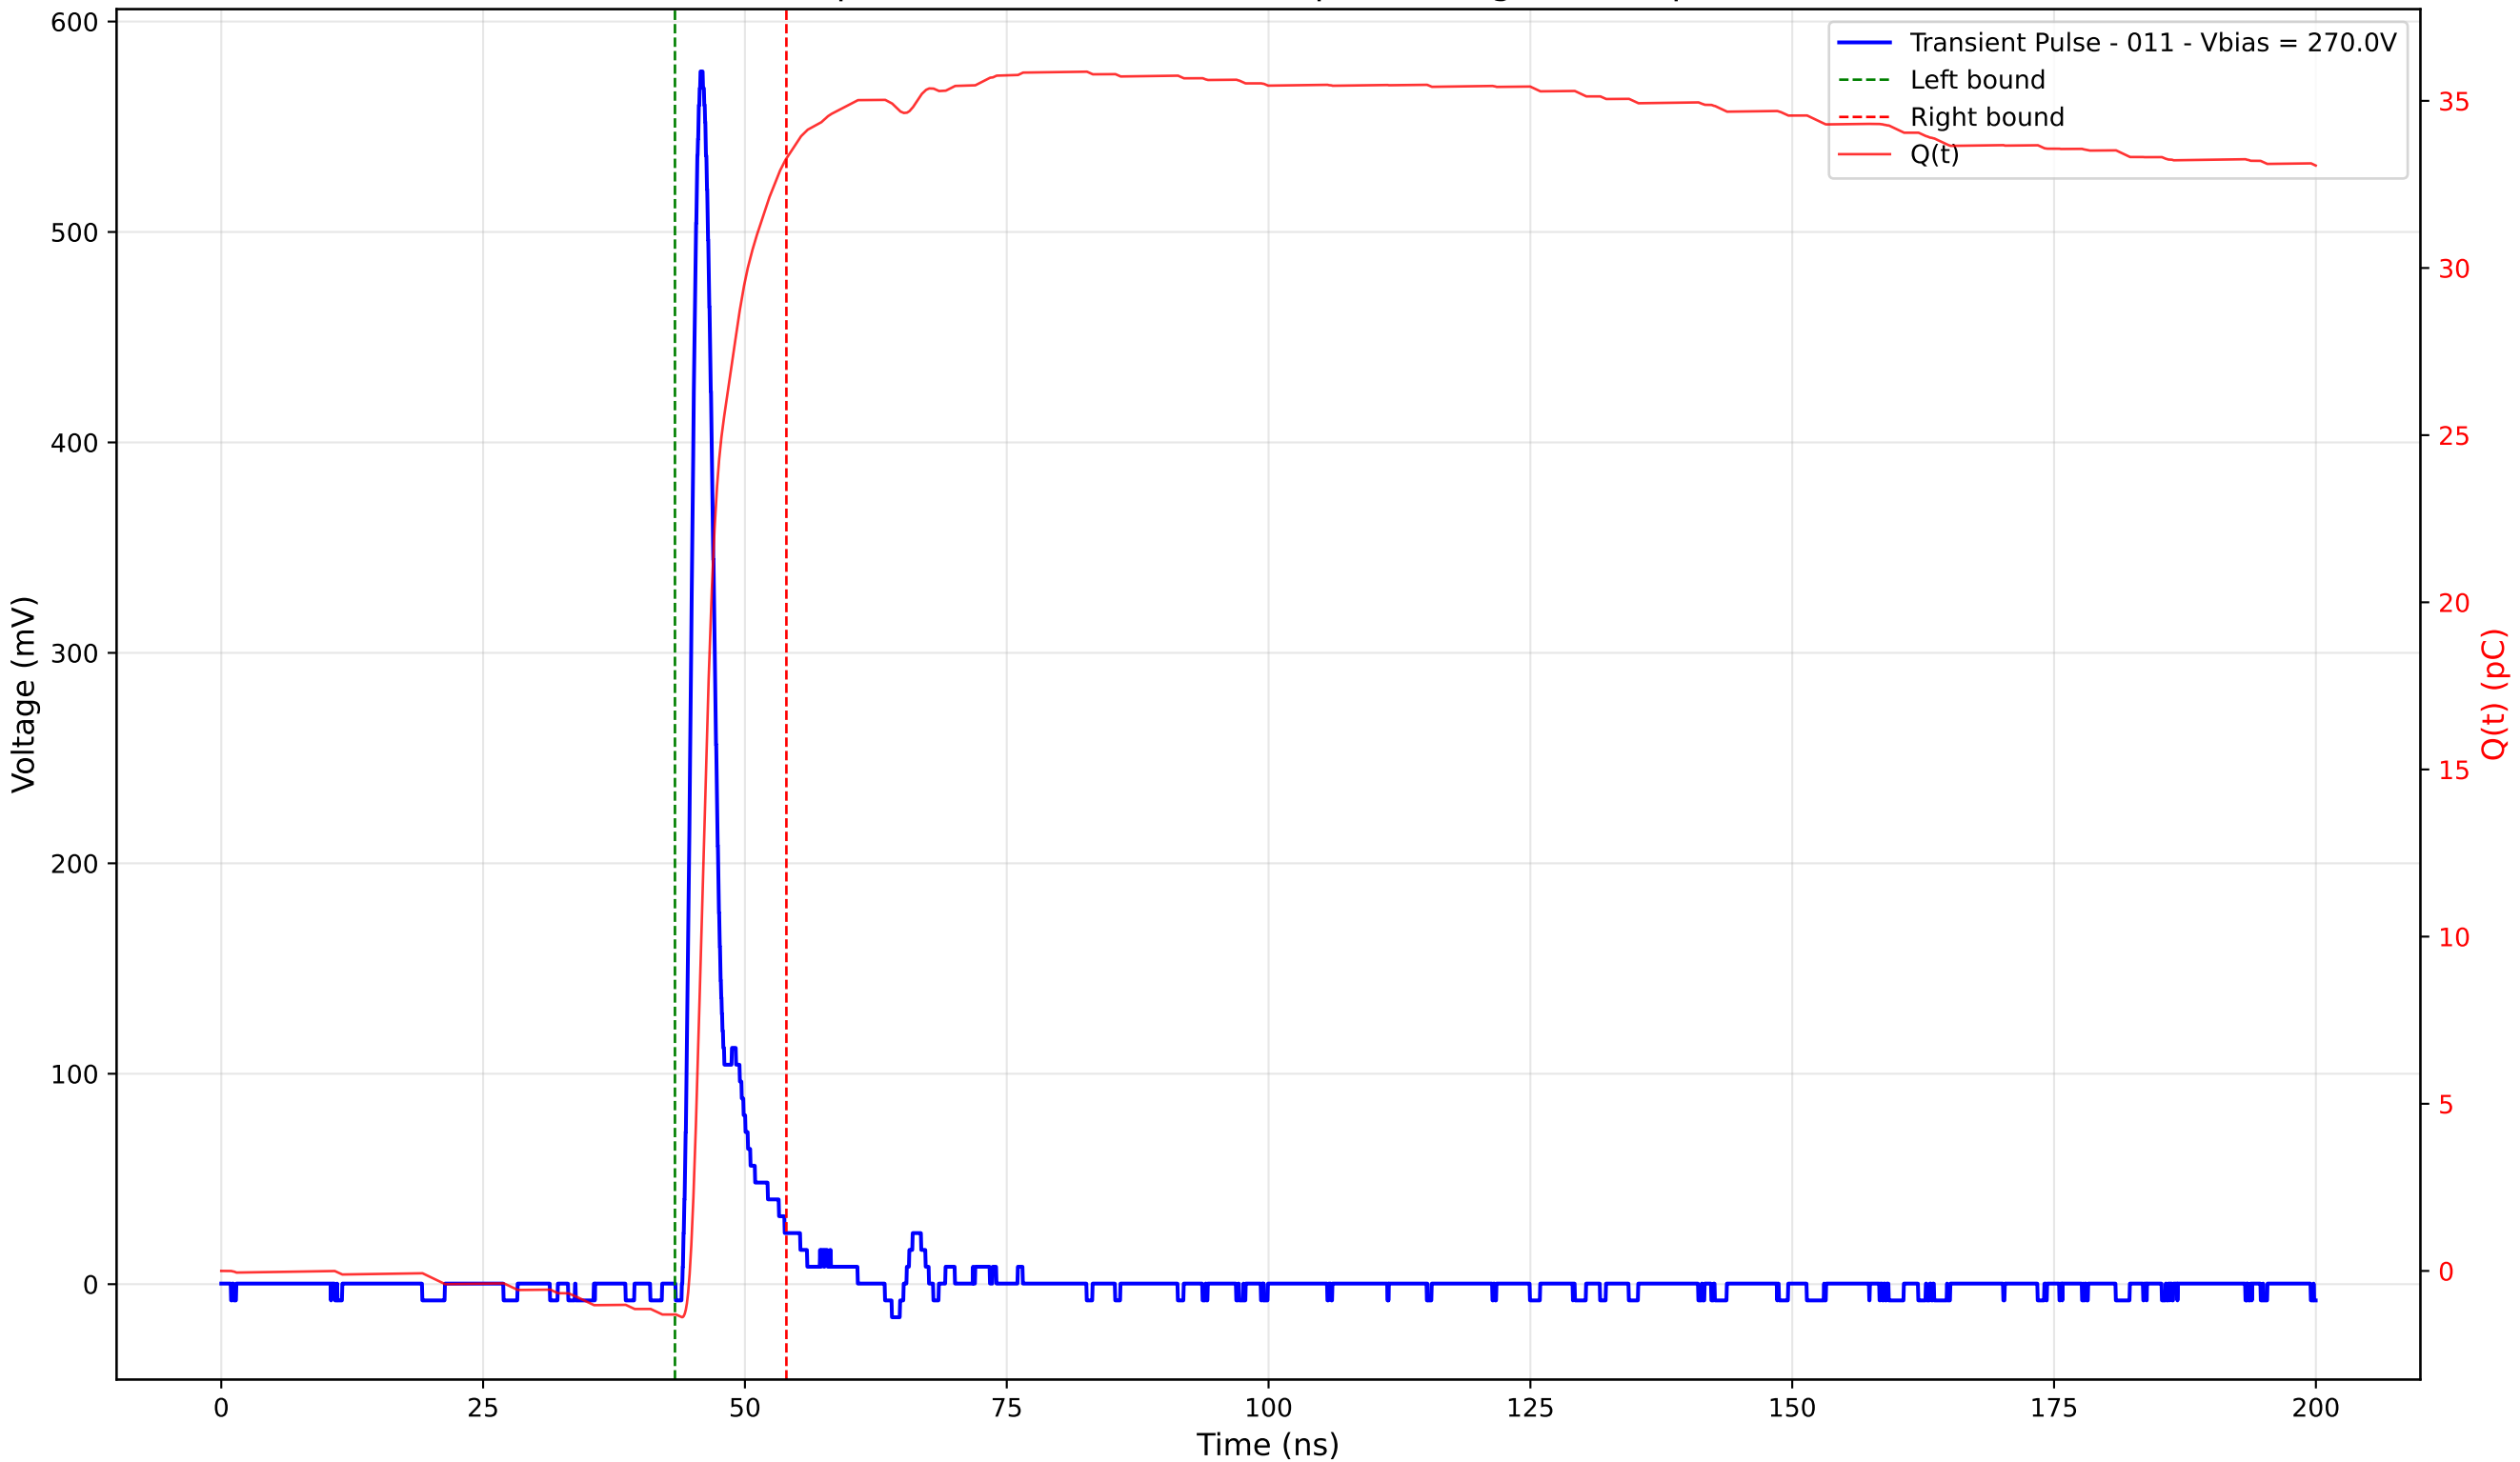


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 34.68 pC - Rise Time: 1.10 ns

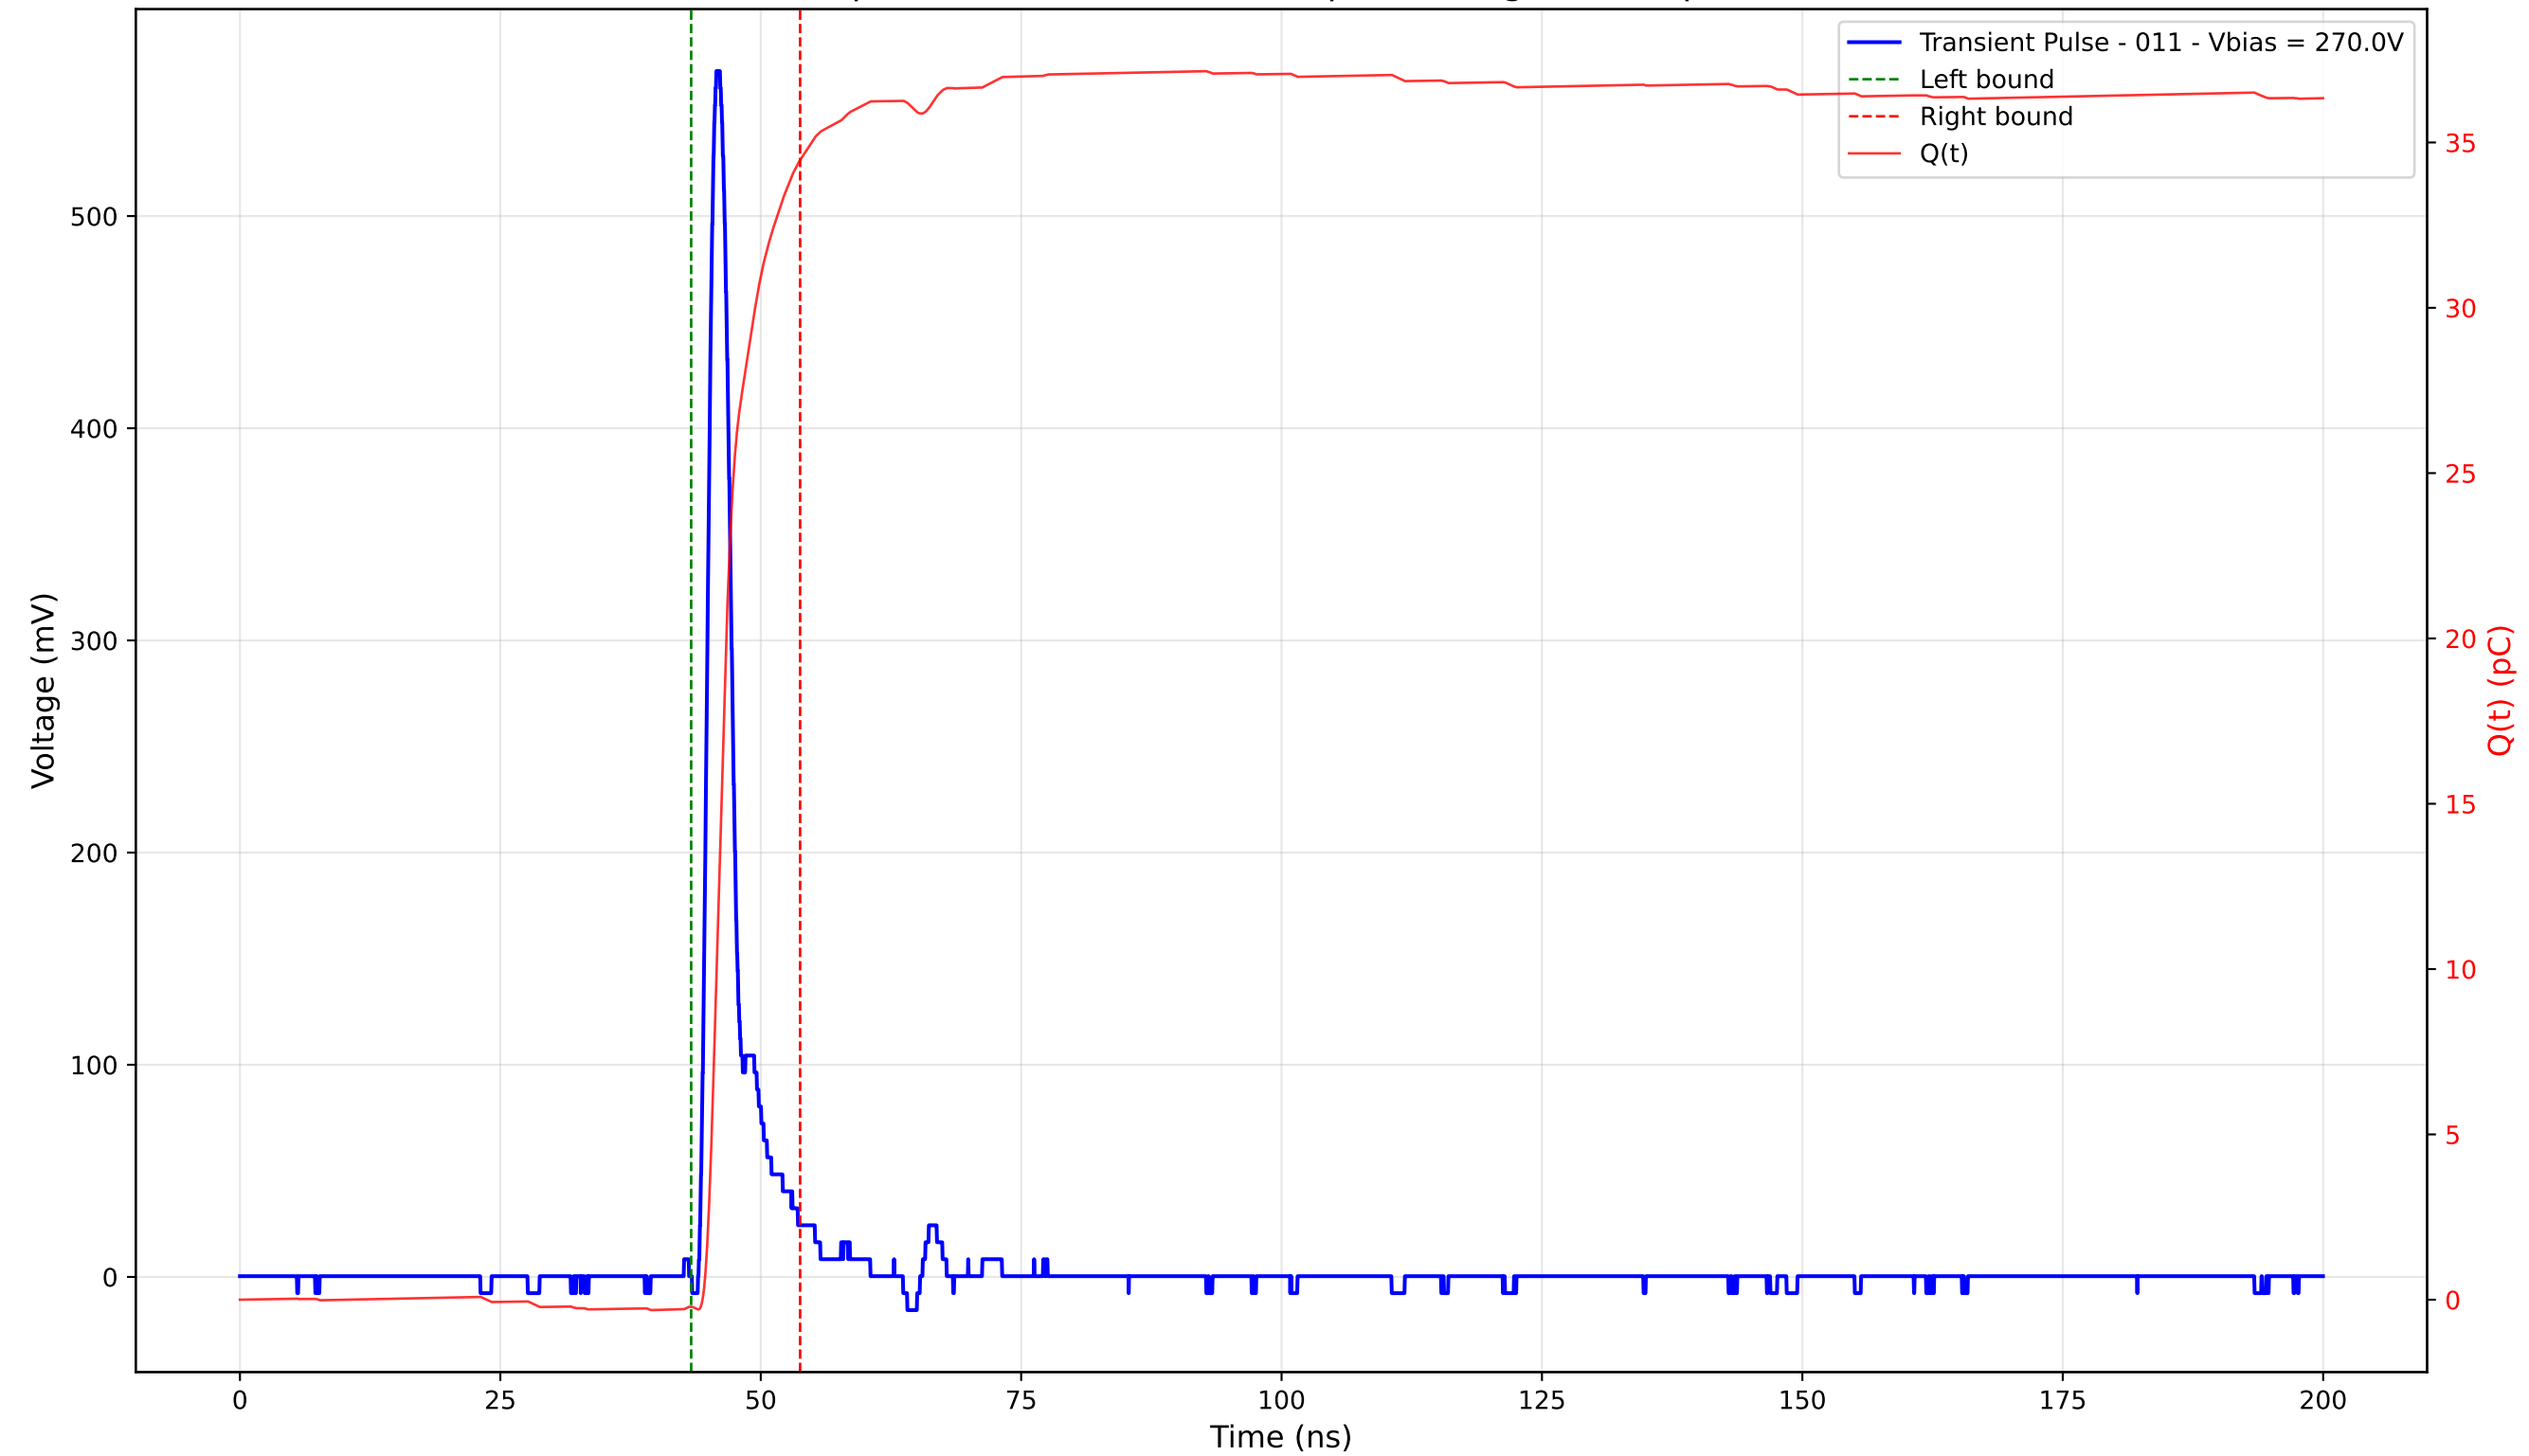


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 35.64 pC - Rise Time: 1.11 ns

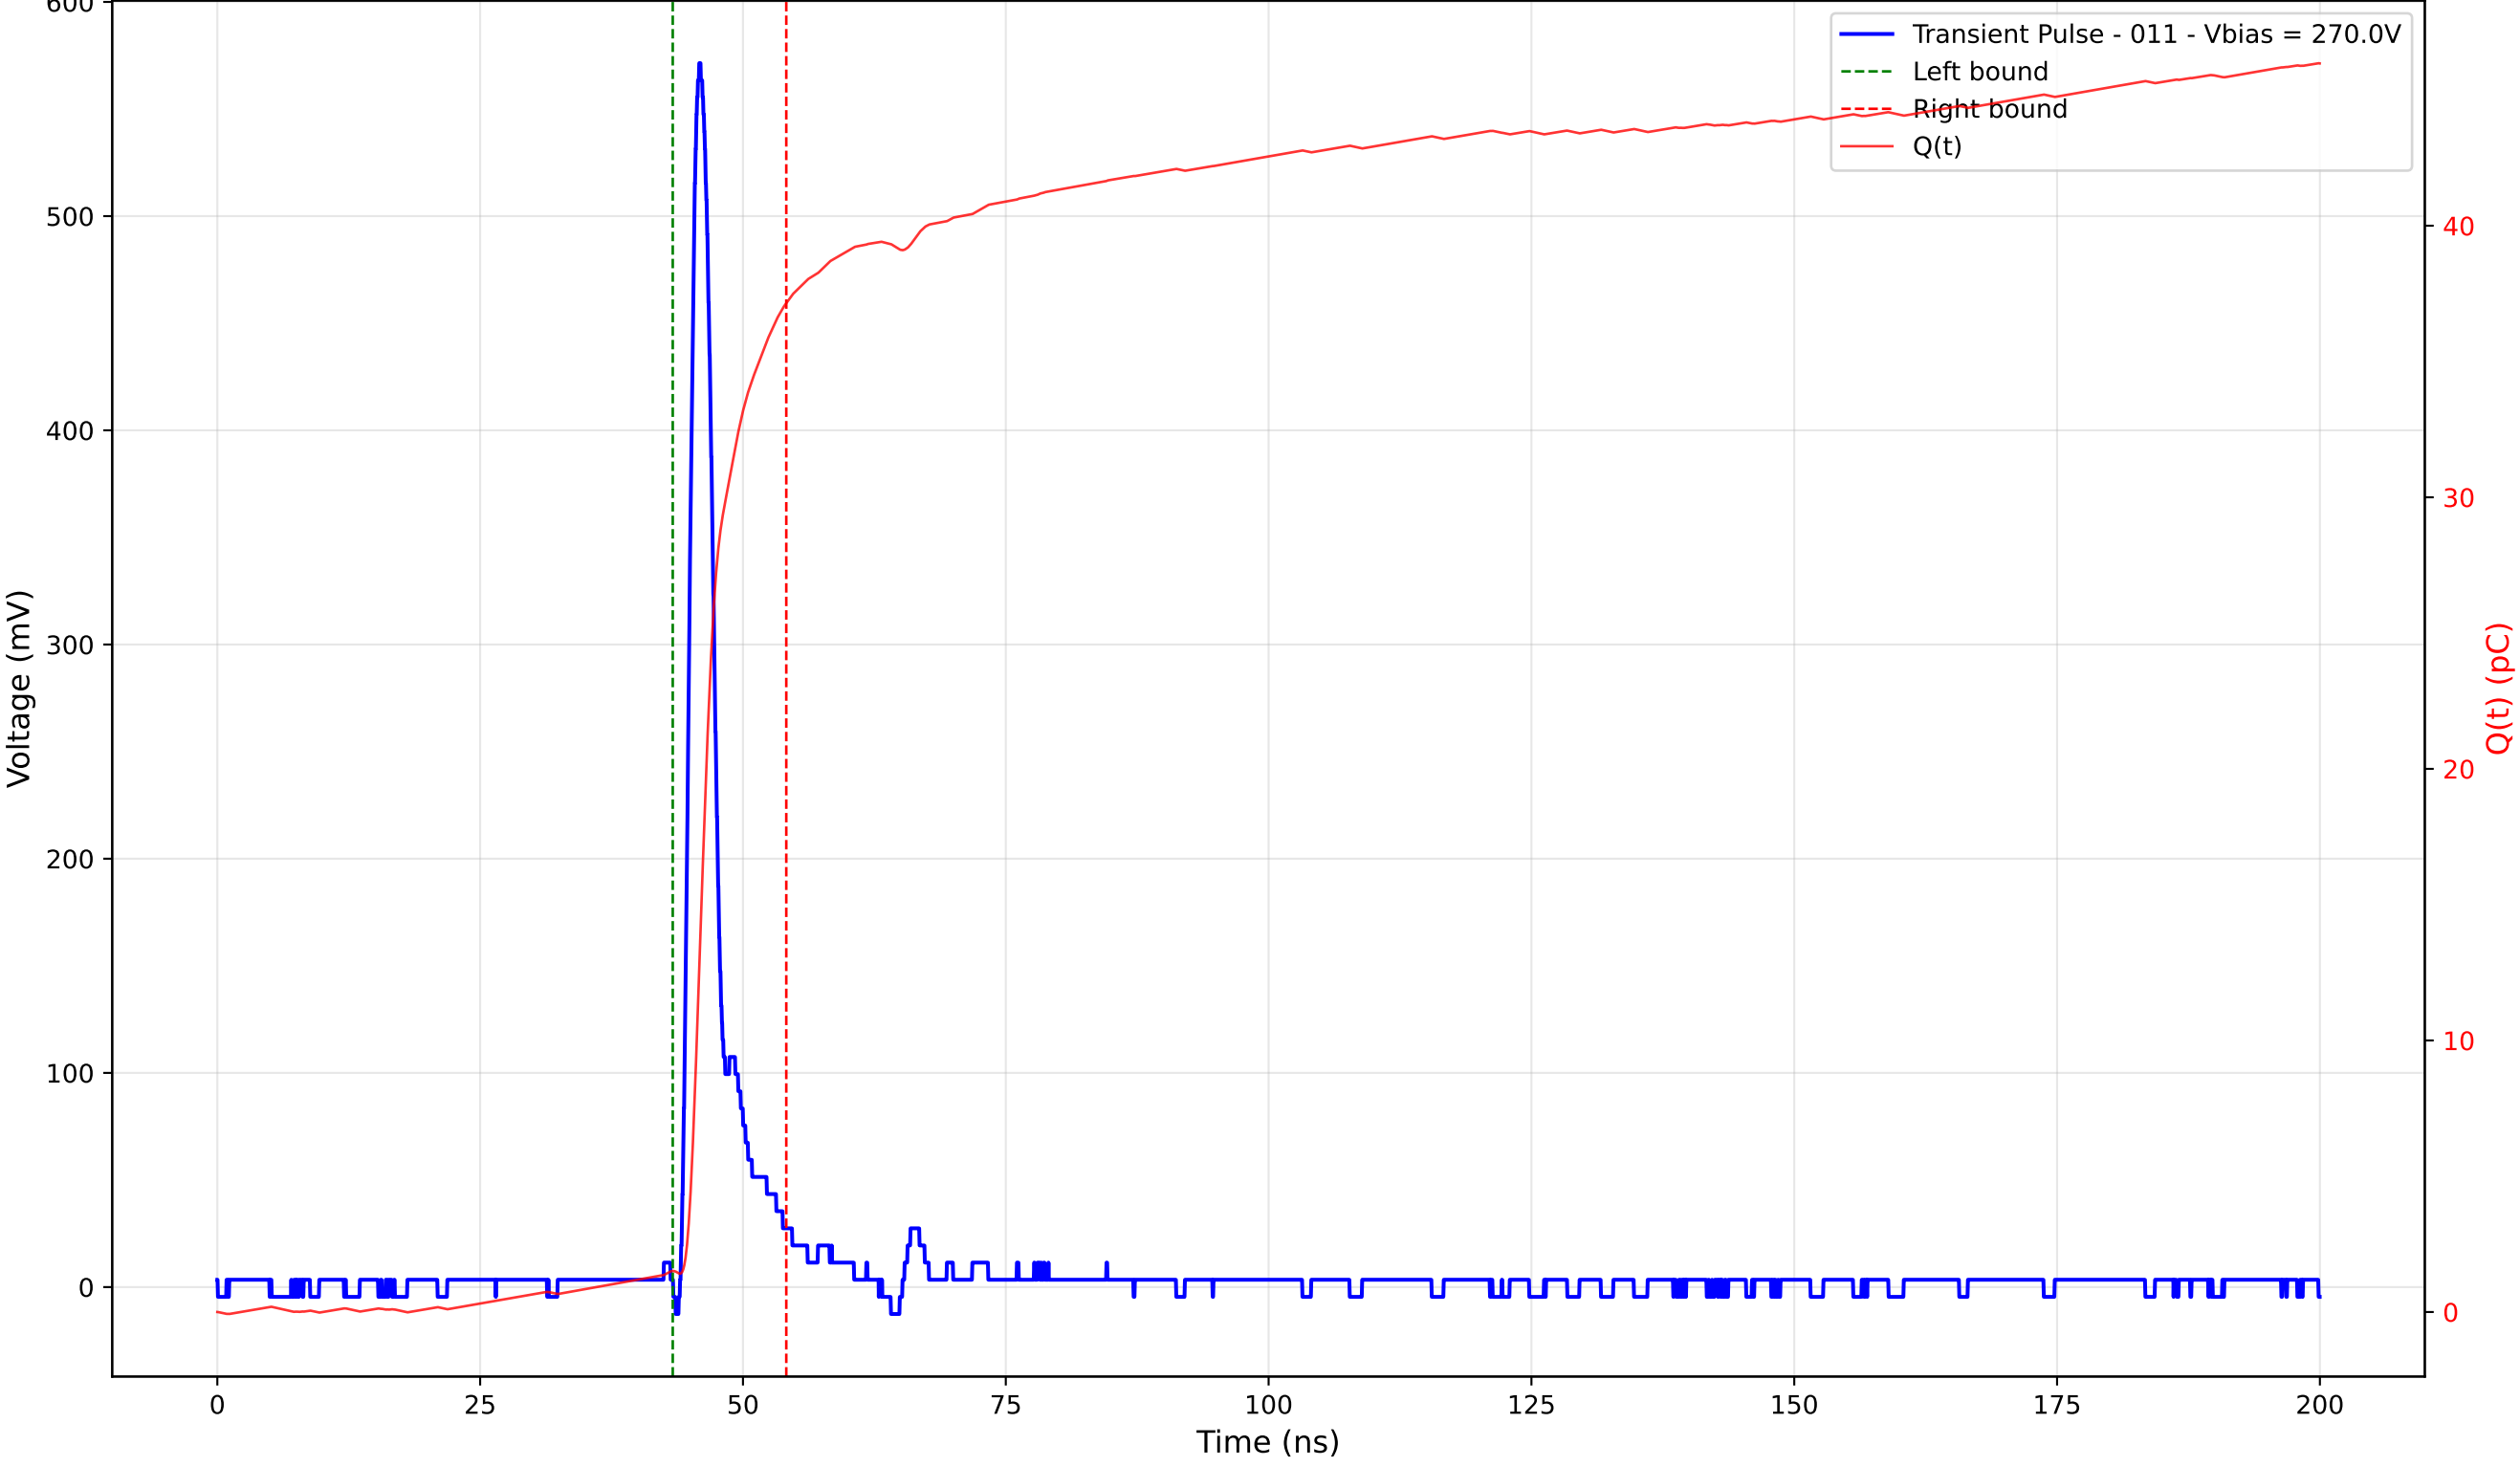


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 34.91 pC - Rise Time: 1.13 ns

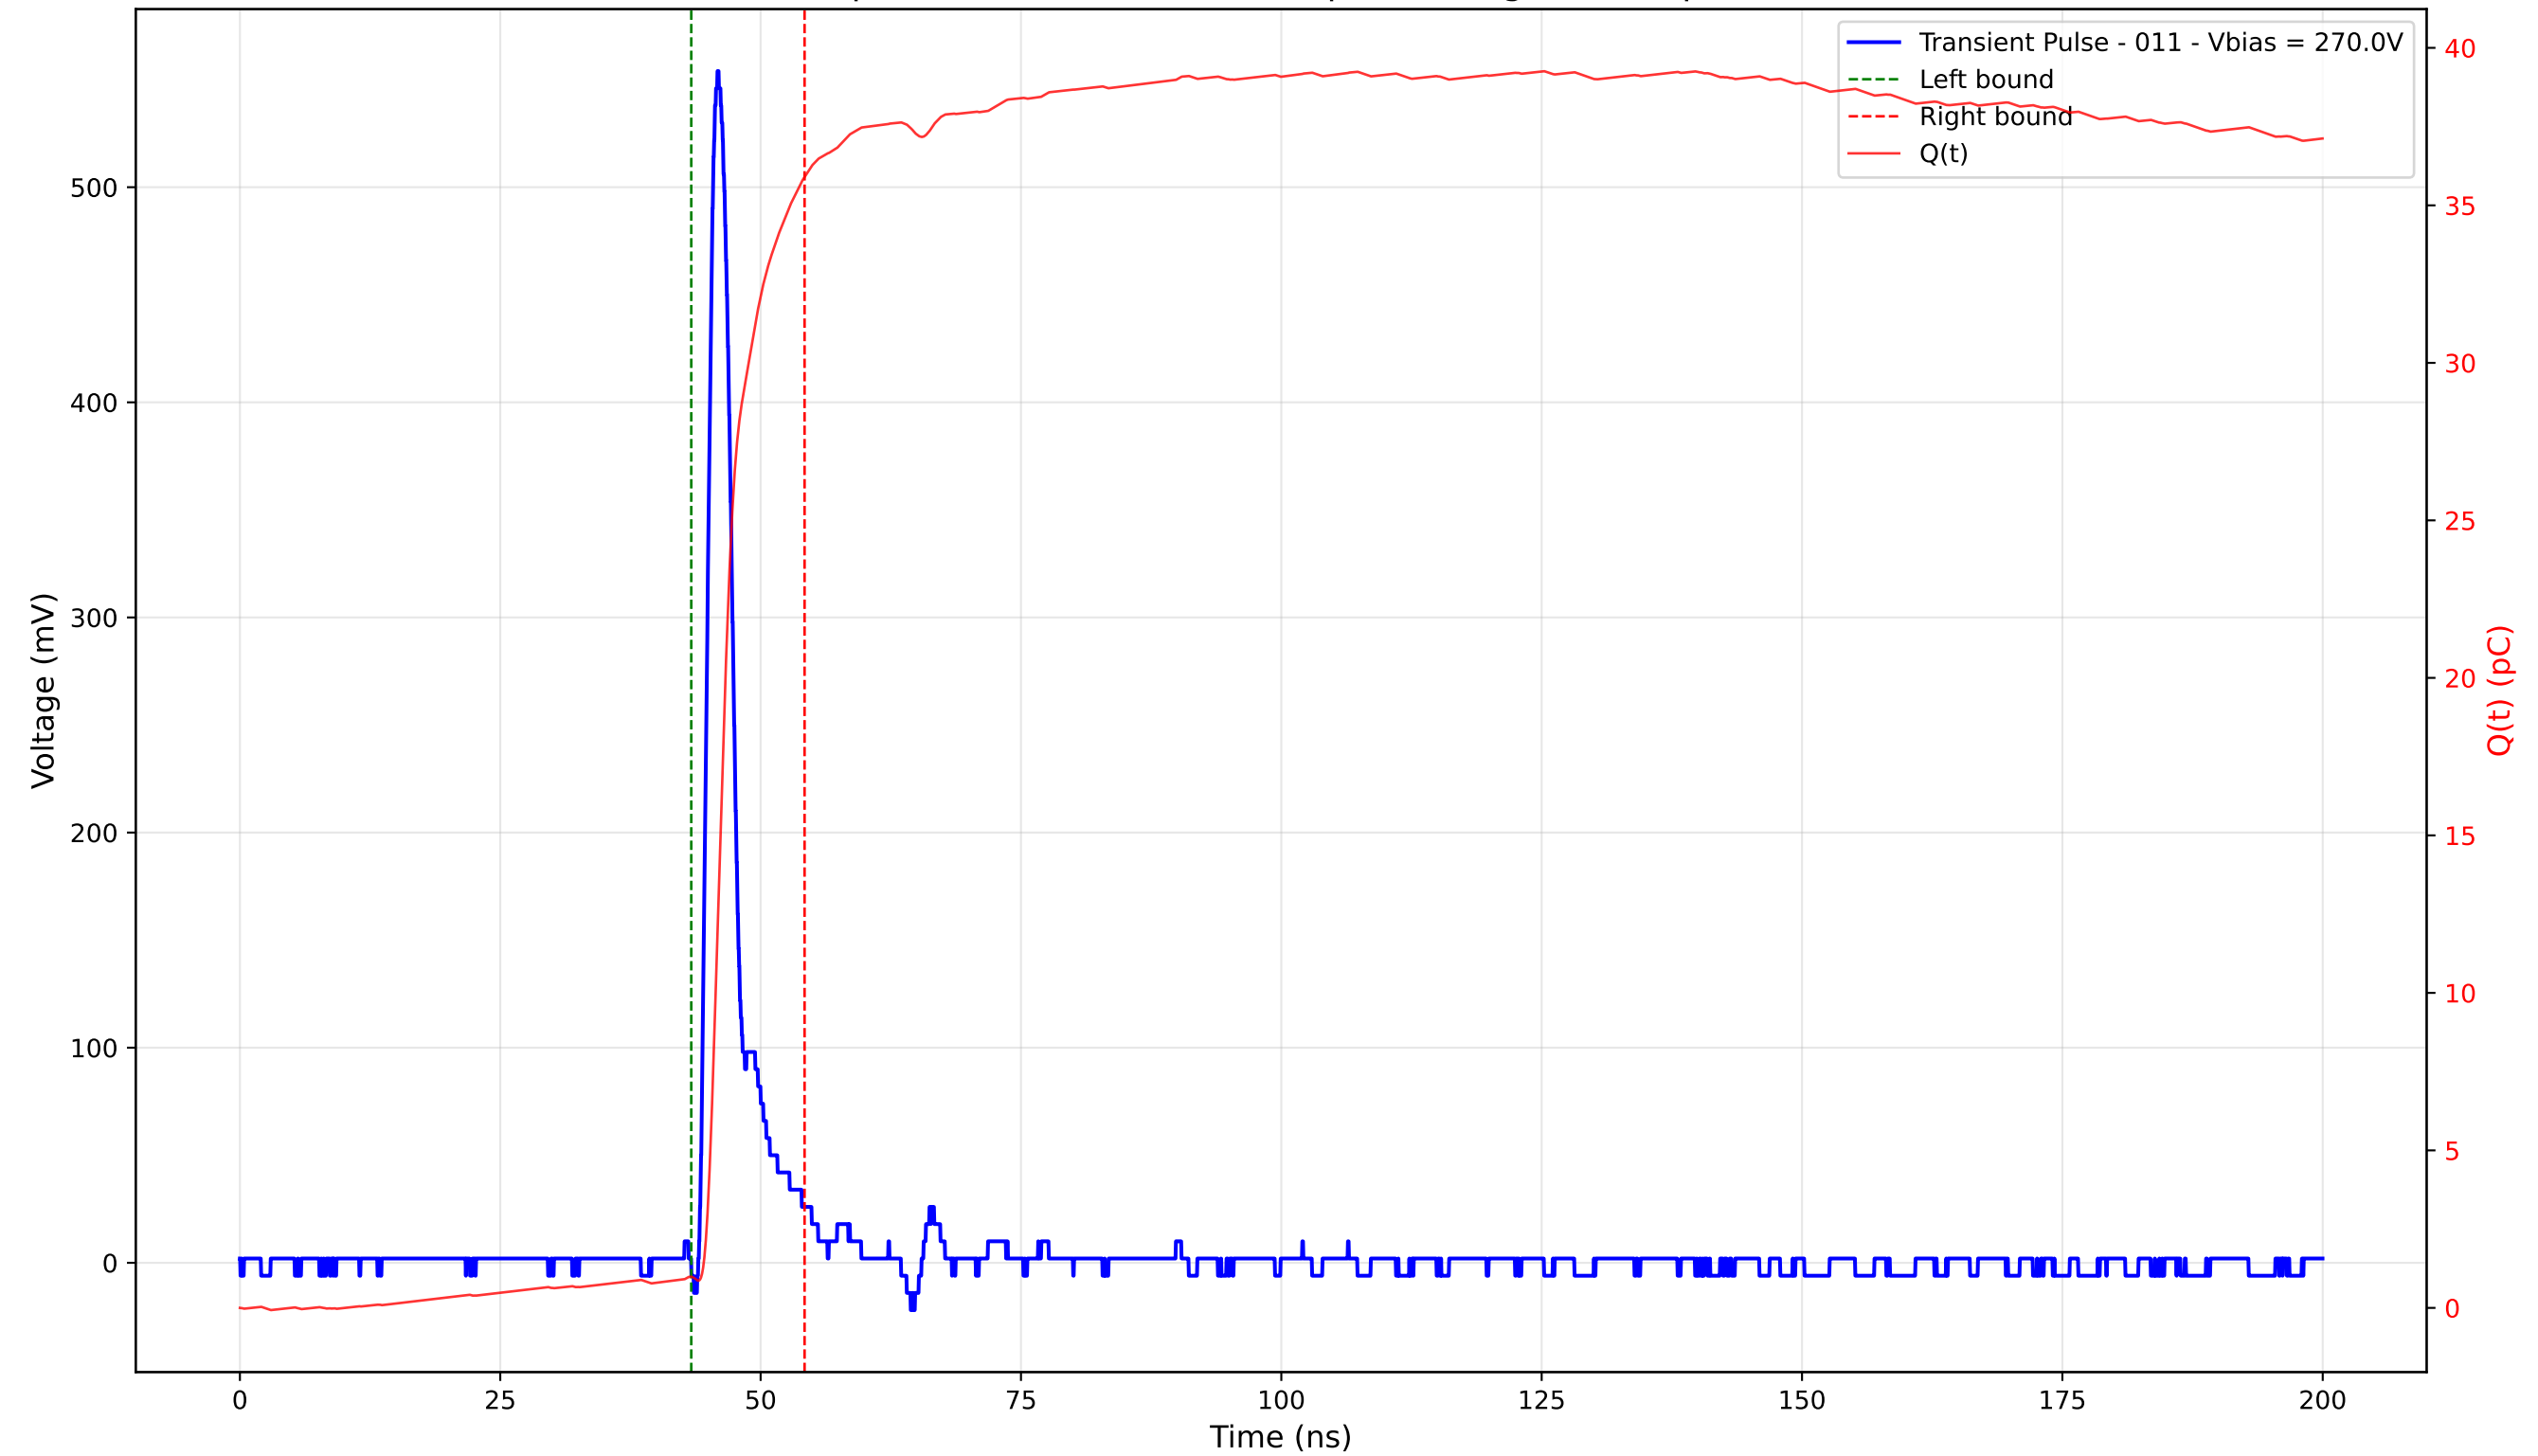


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 34.63 pC - Rise Time: 1.10 ns

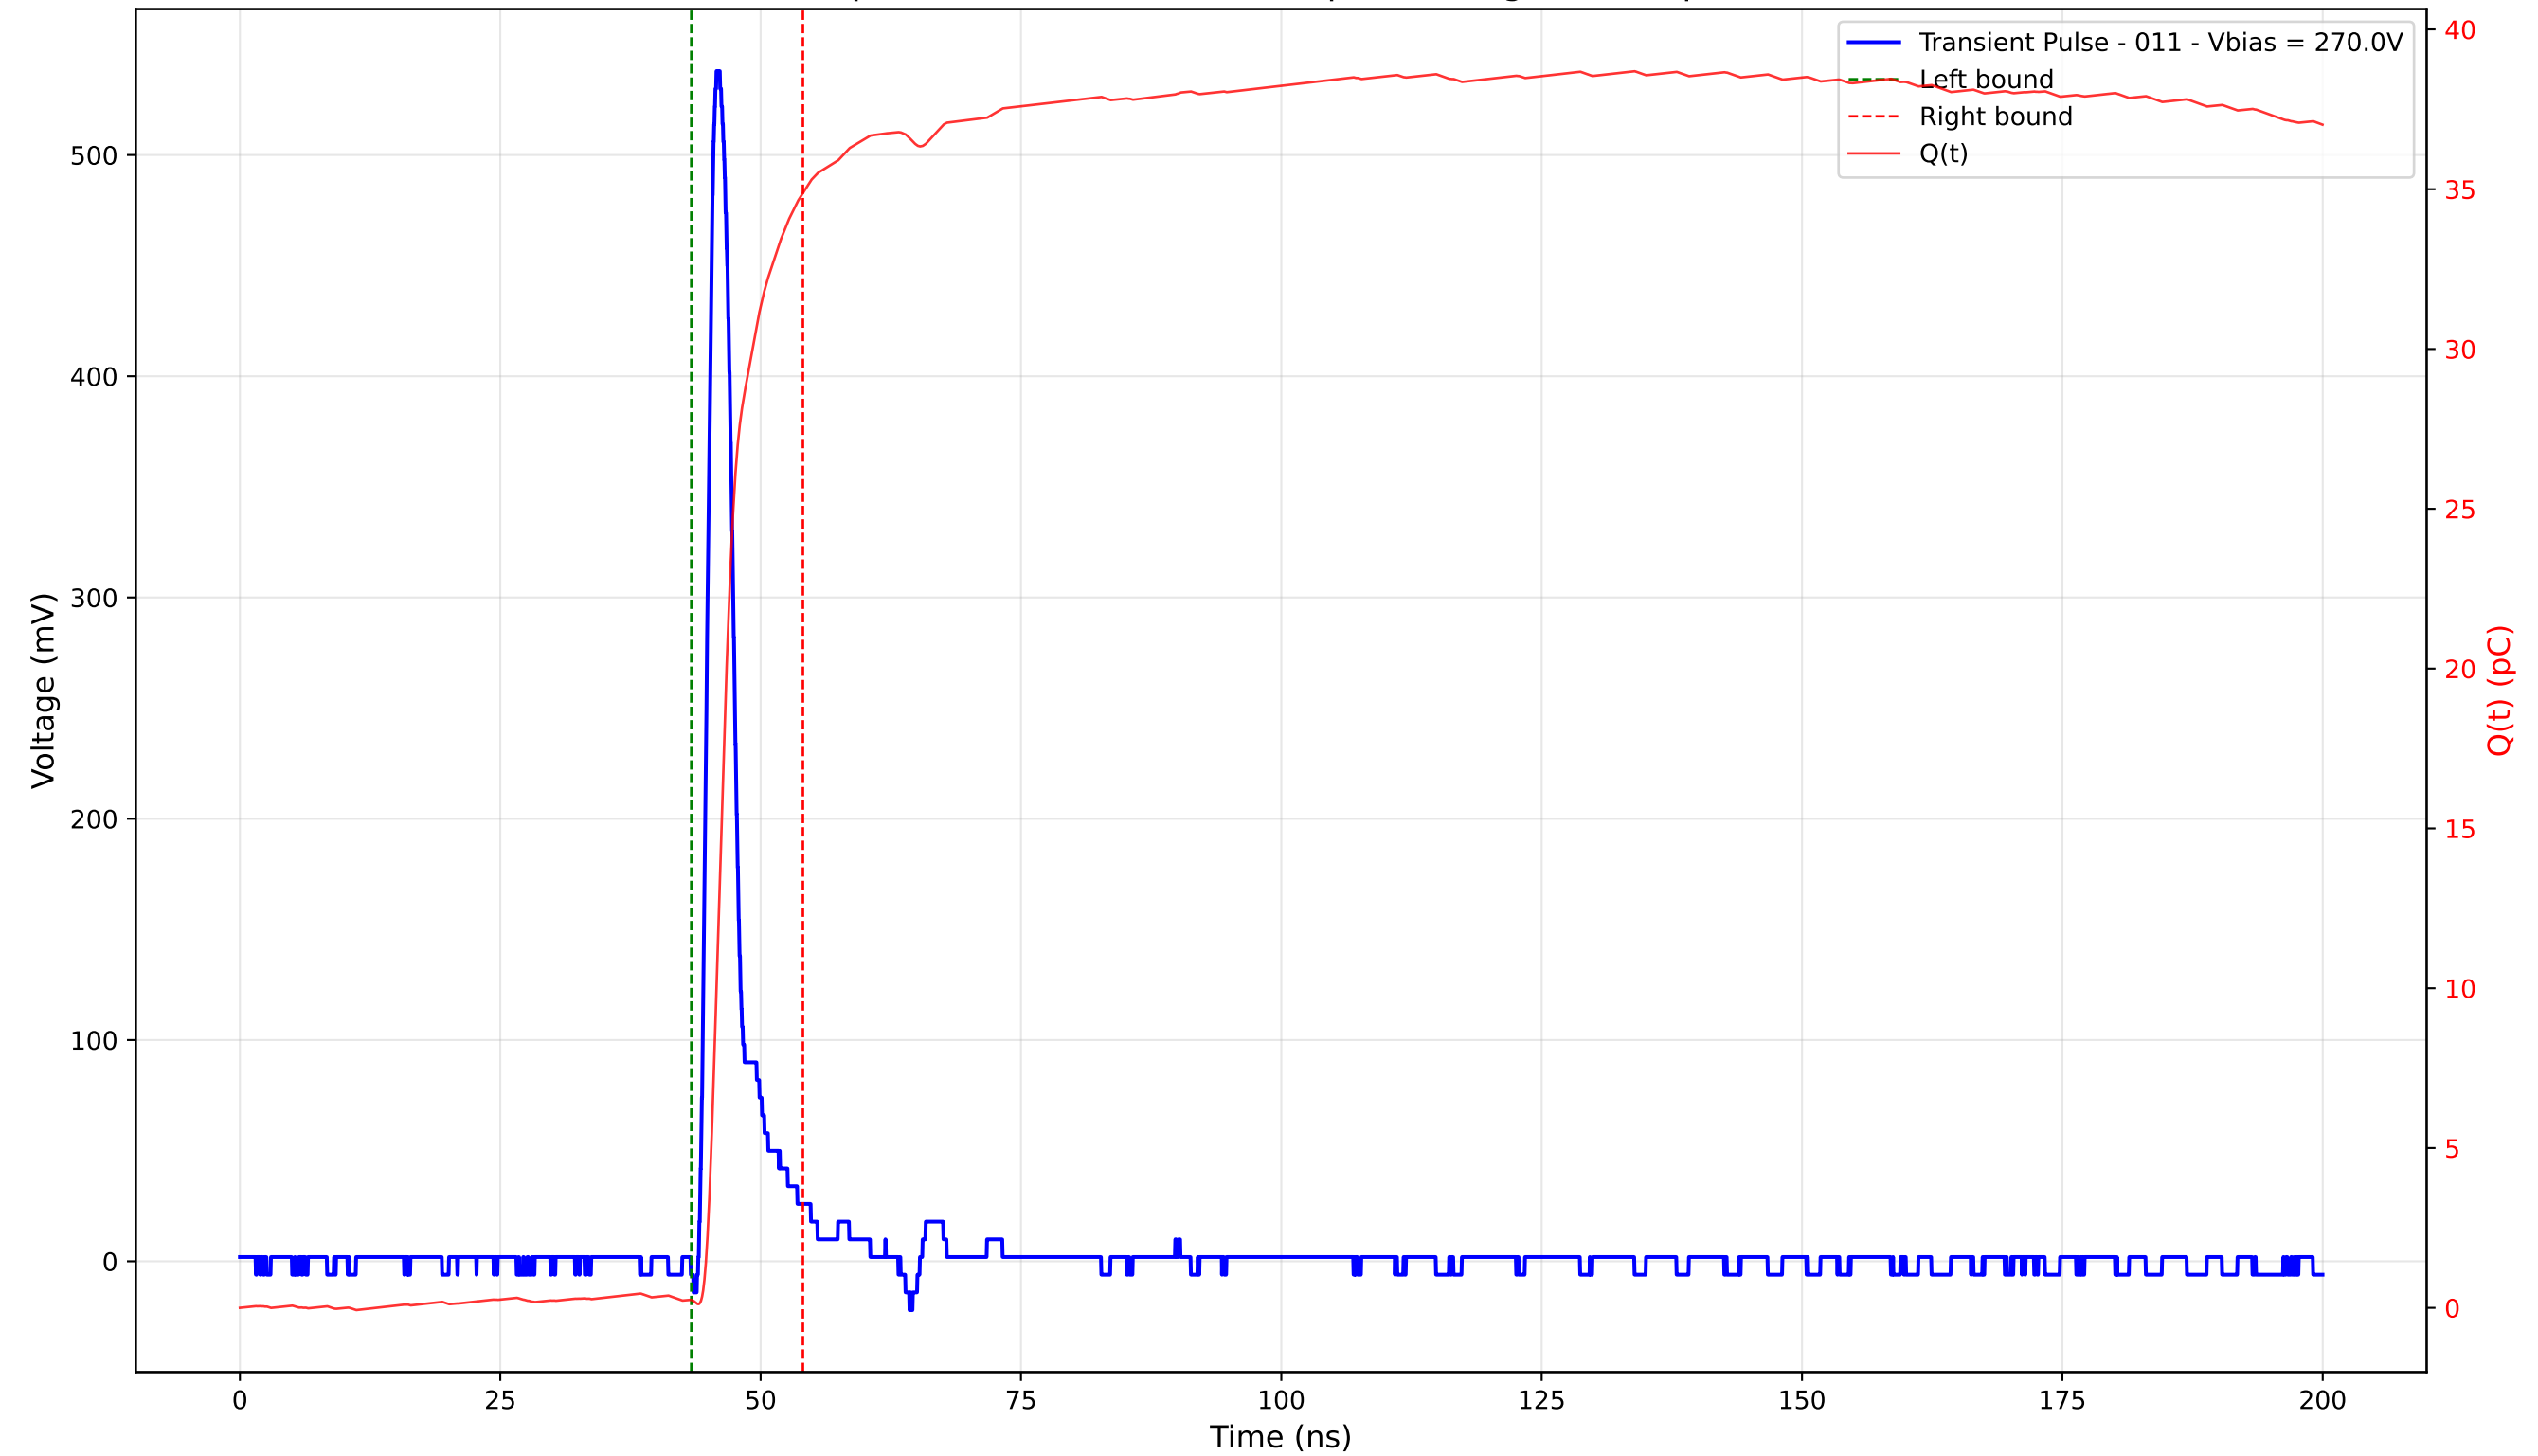


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 34.72 pC - Rise Time: 1.11 ns

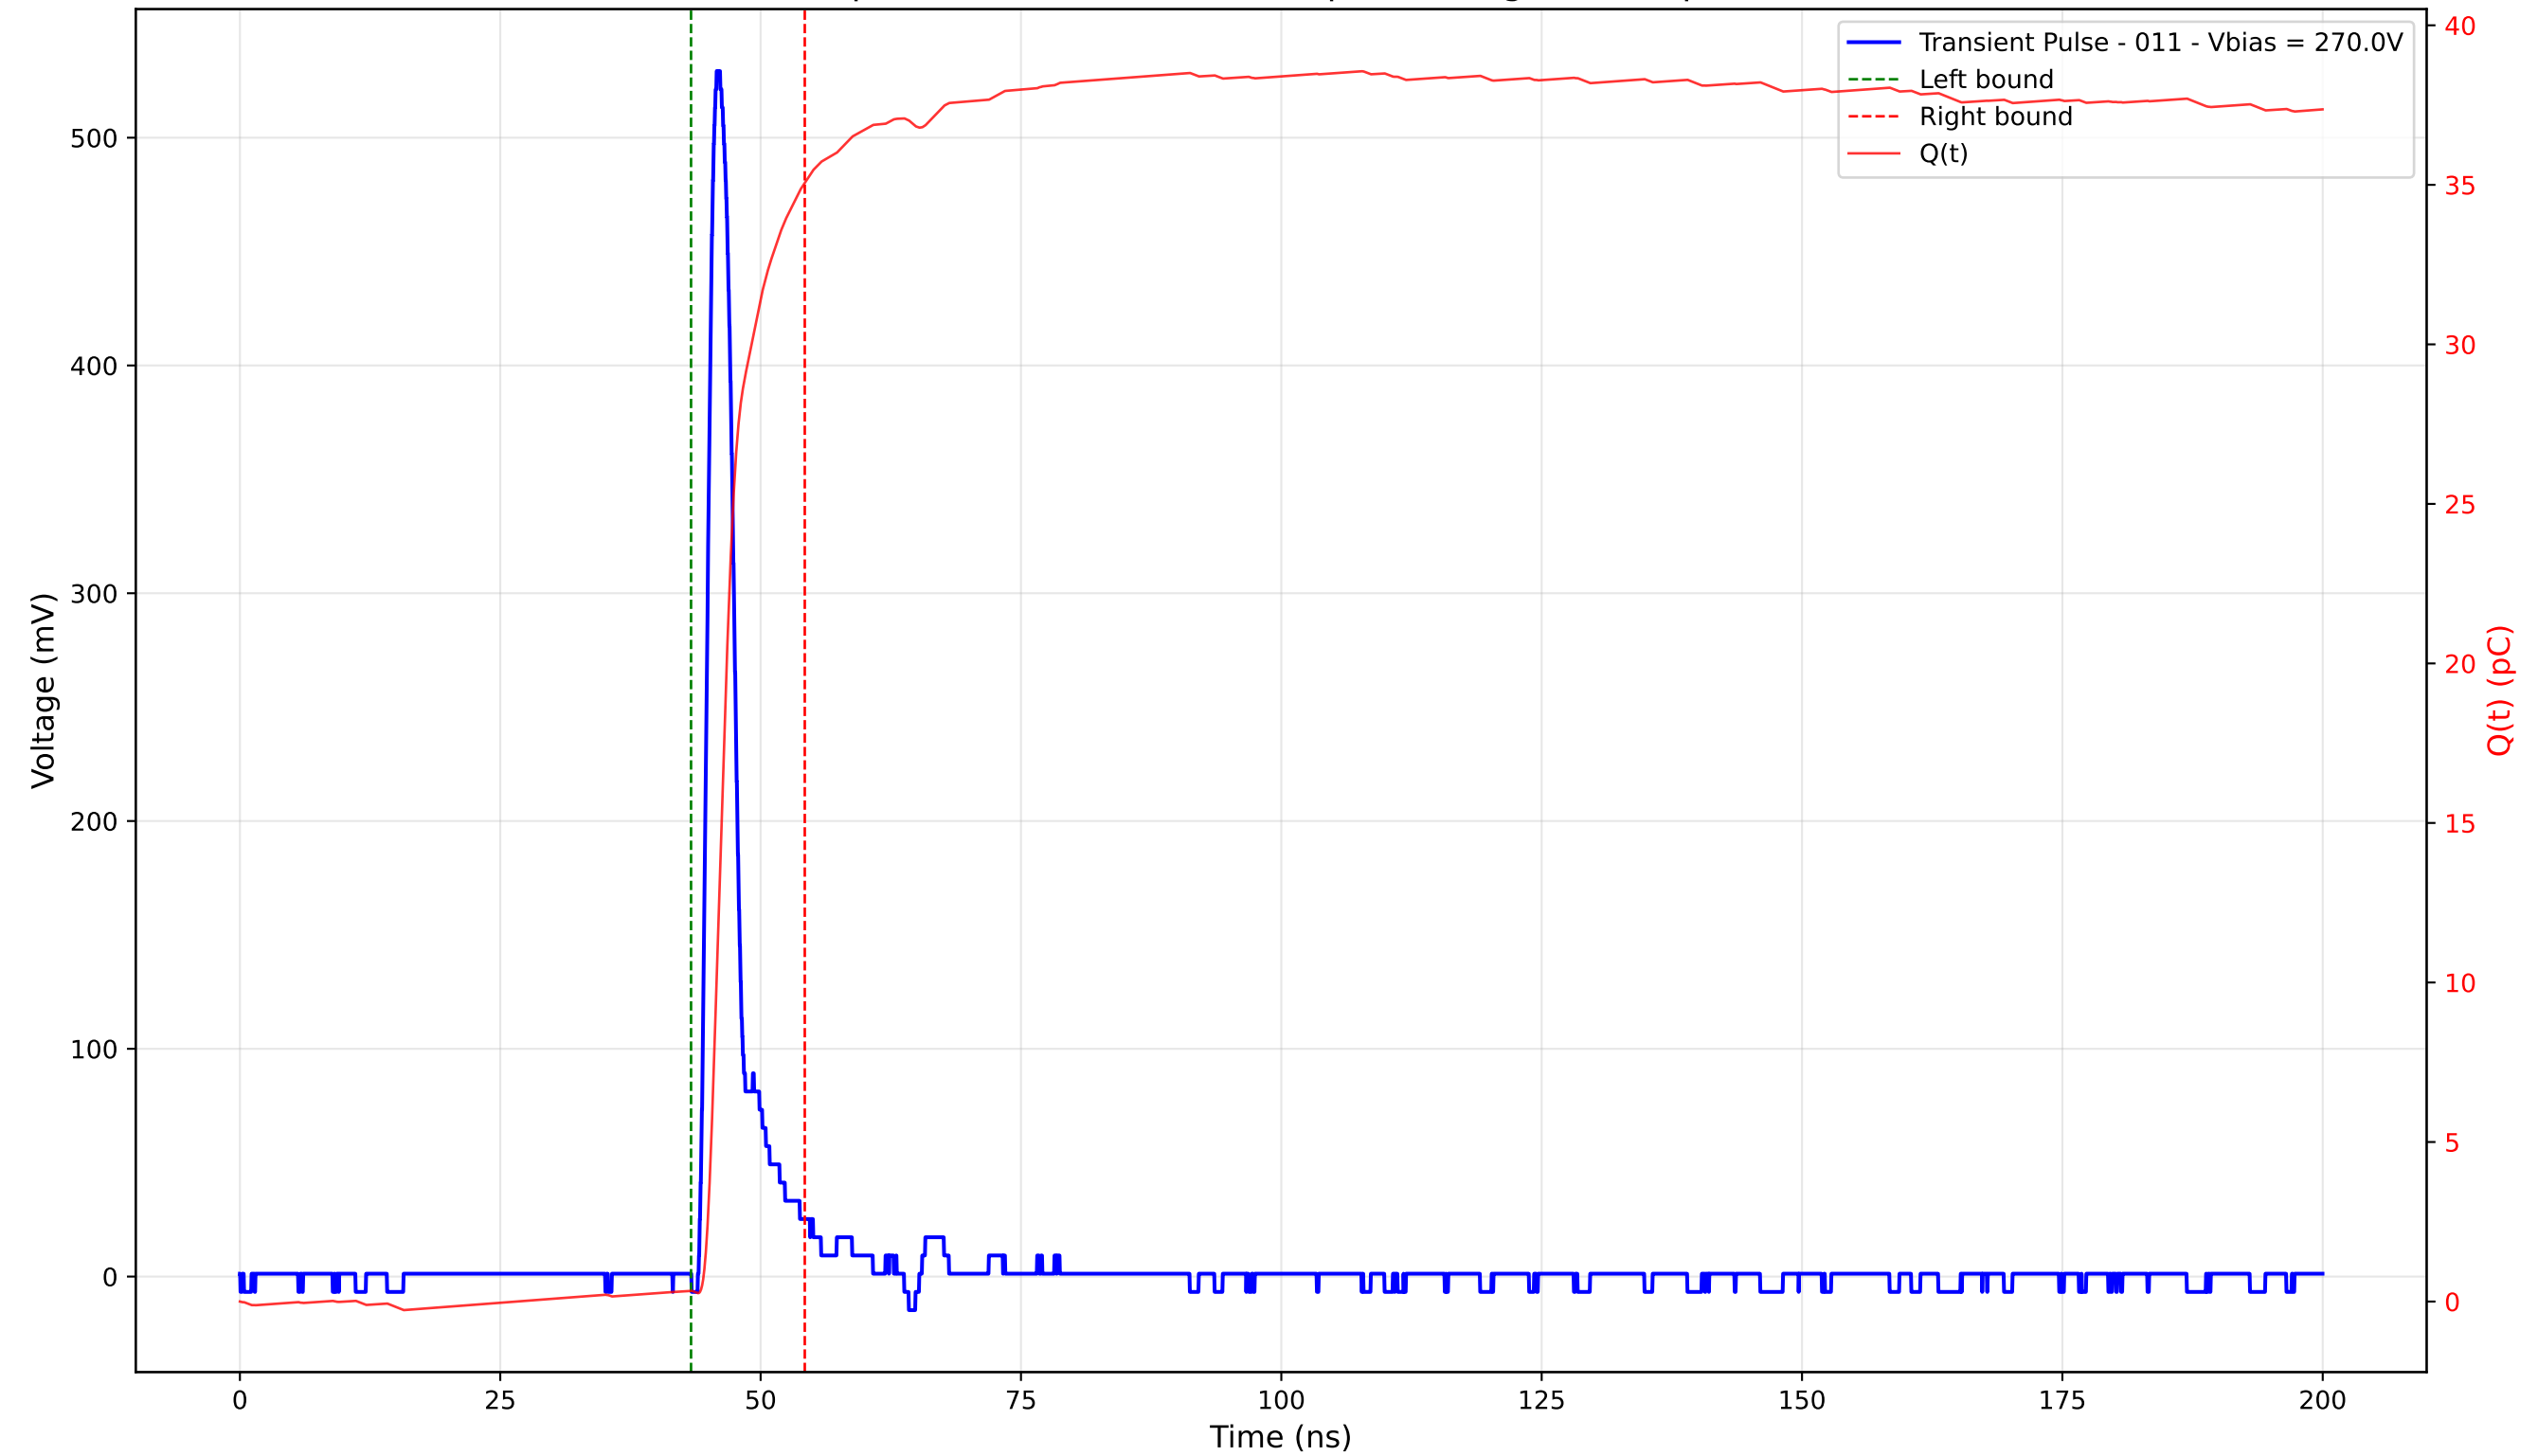


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 34.82 pC - Rise Time: 1.12 ns

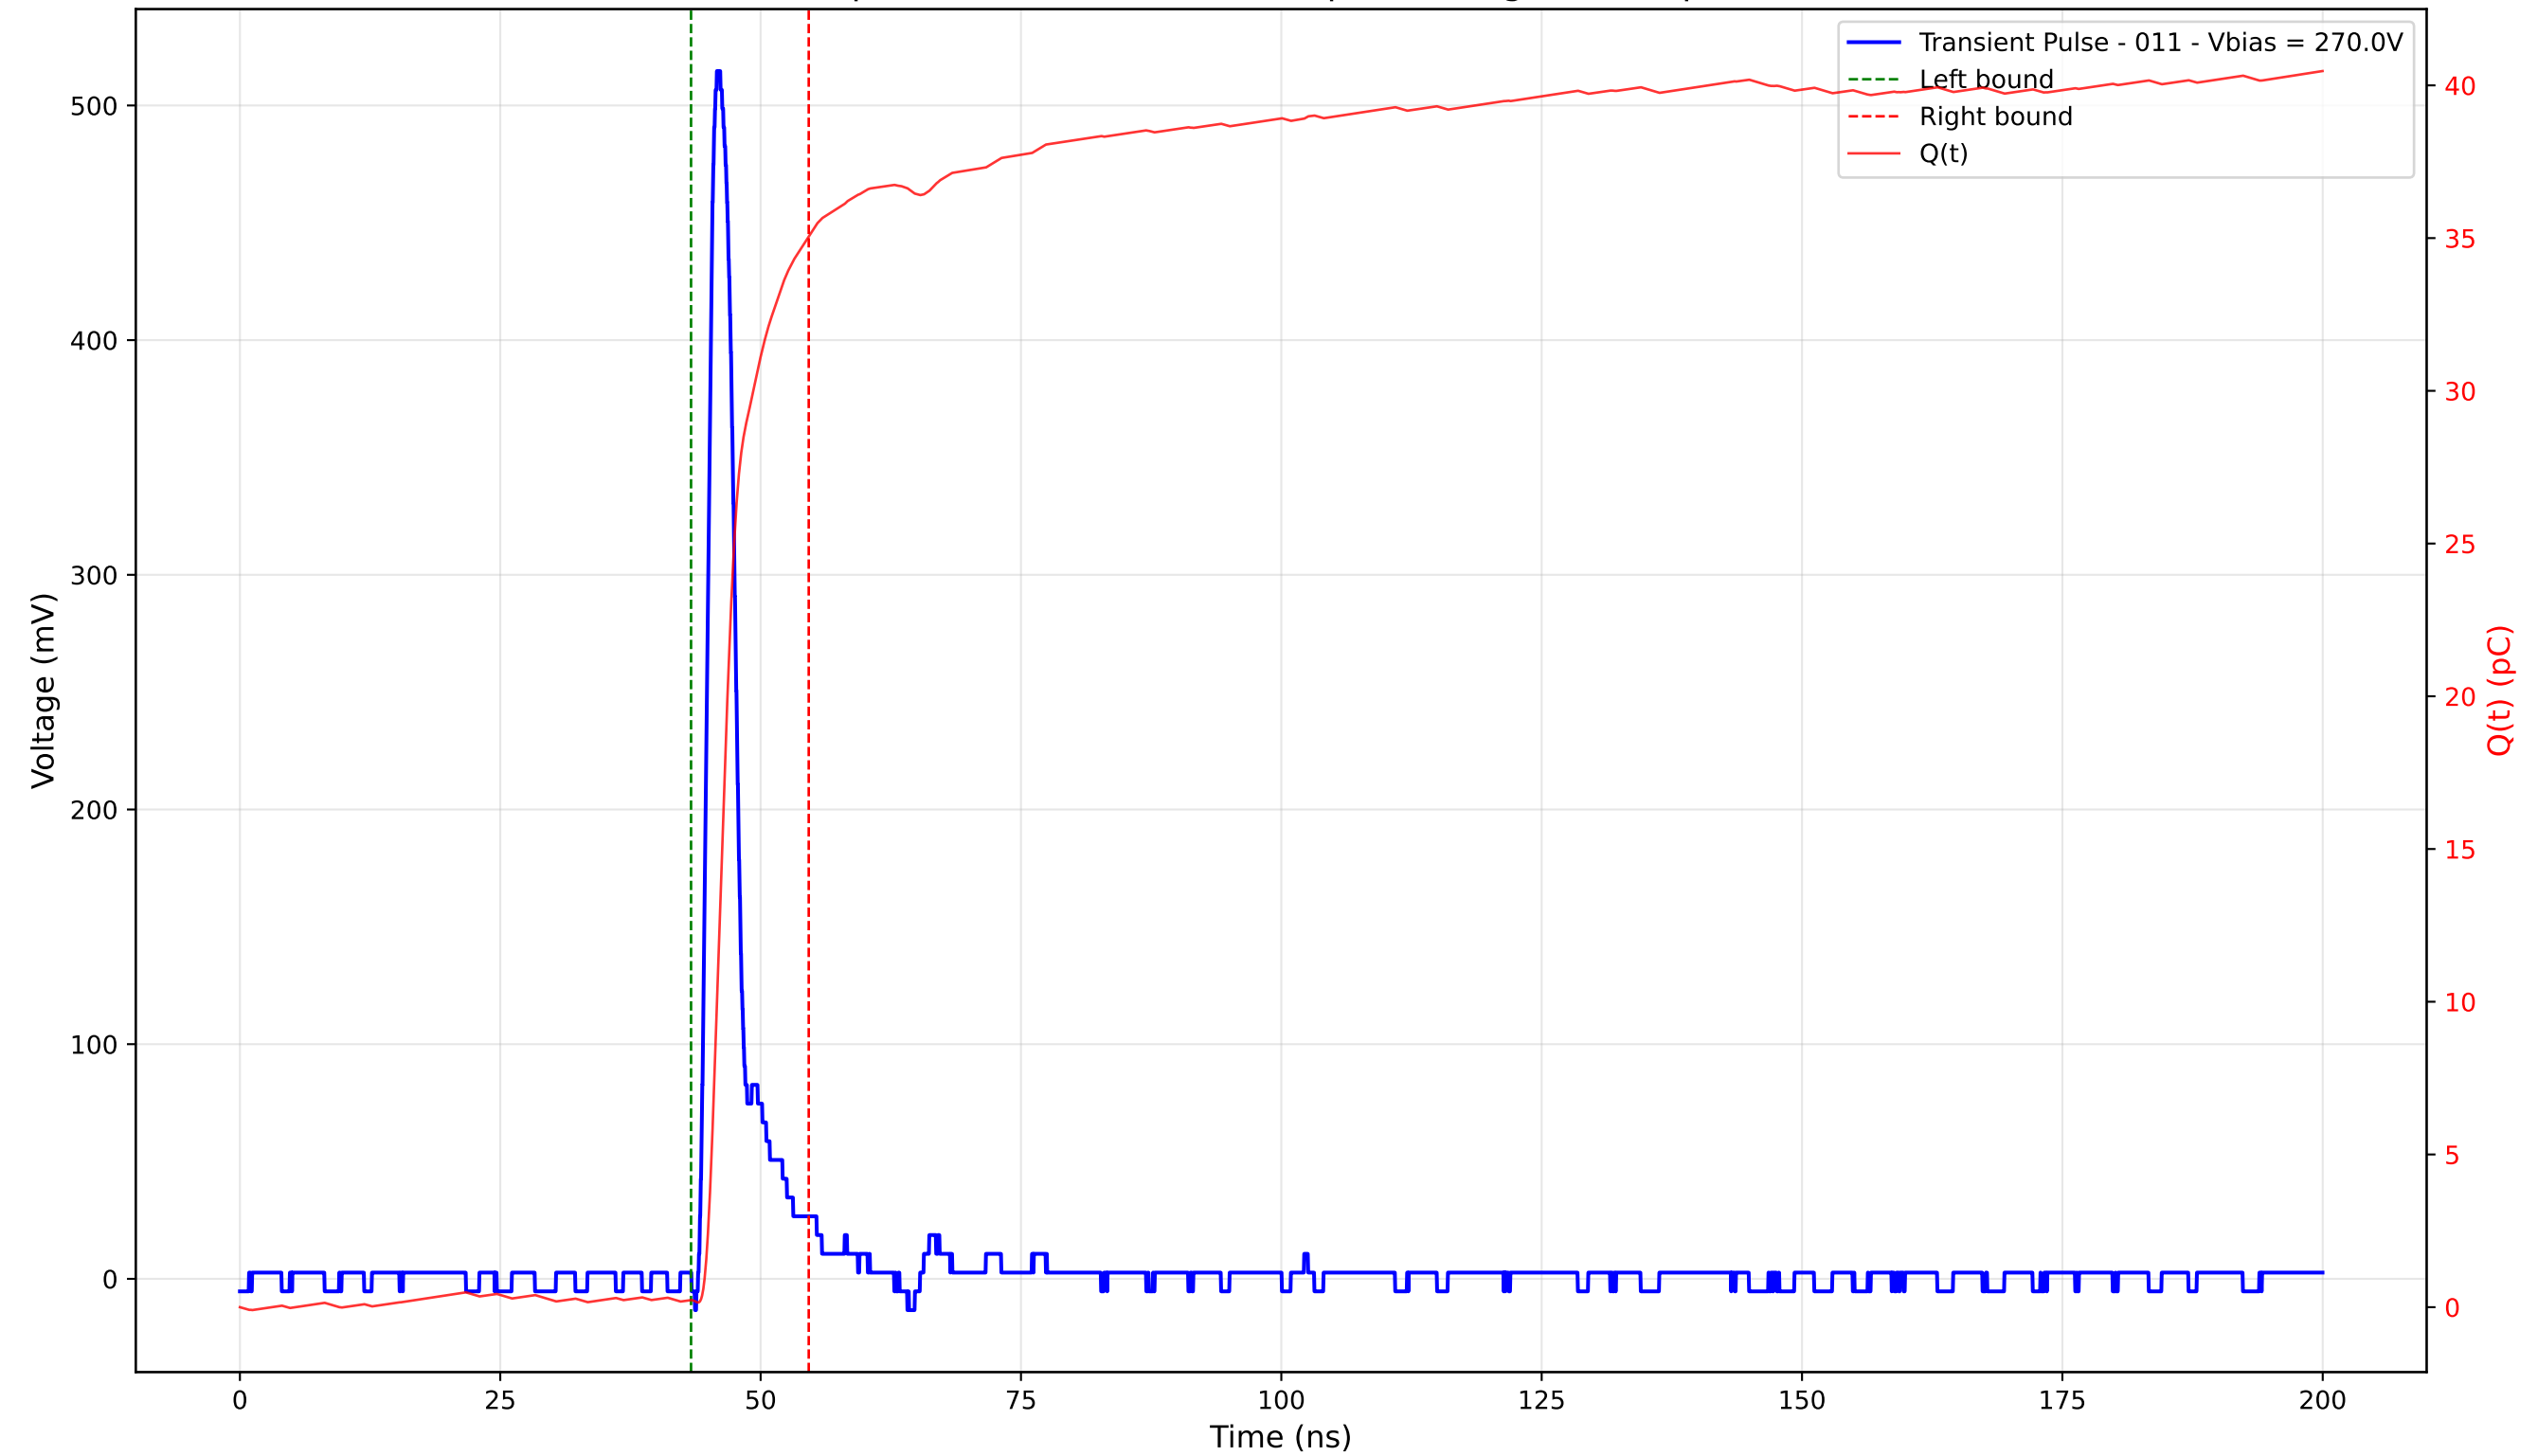


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 33.98 pC - Rise Time: 1.10 ns

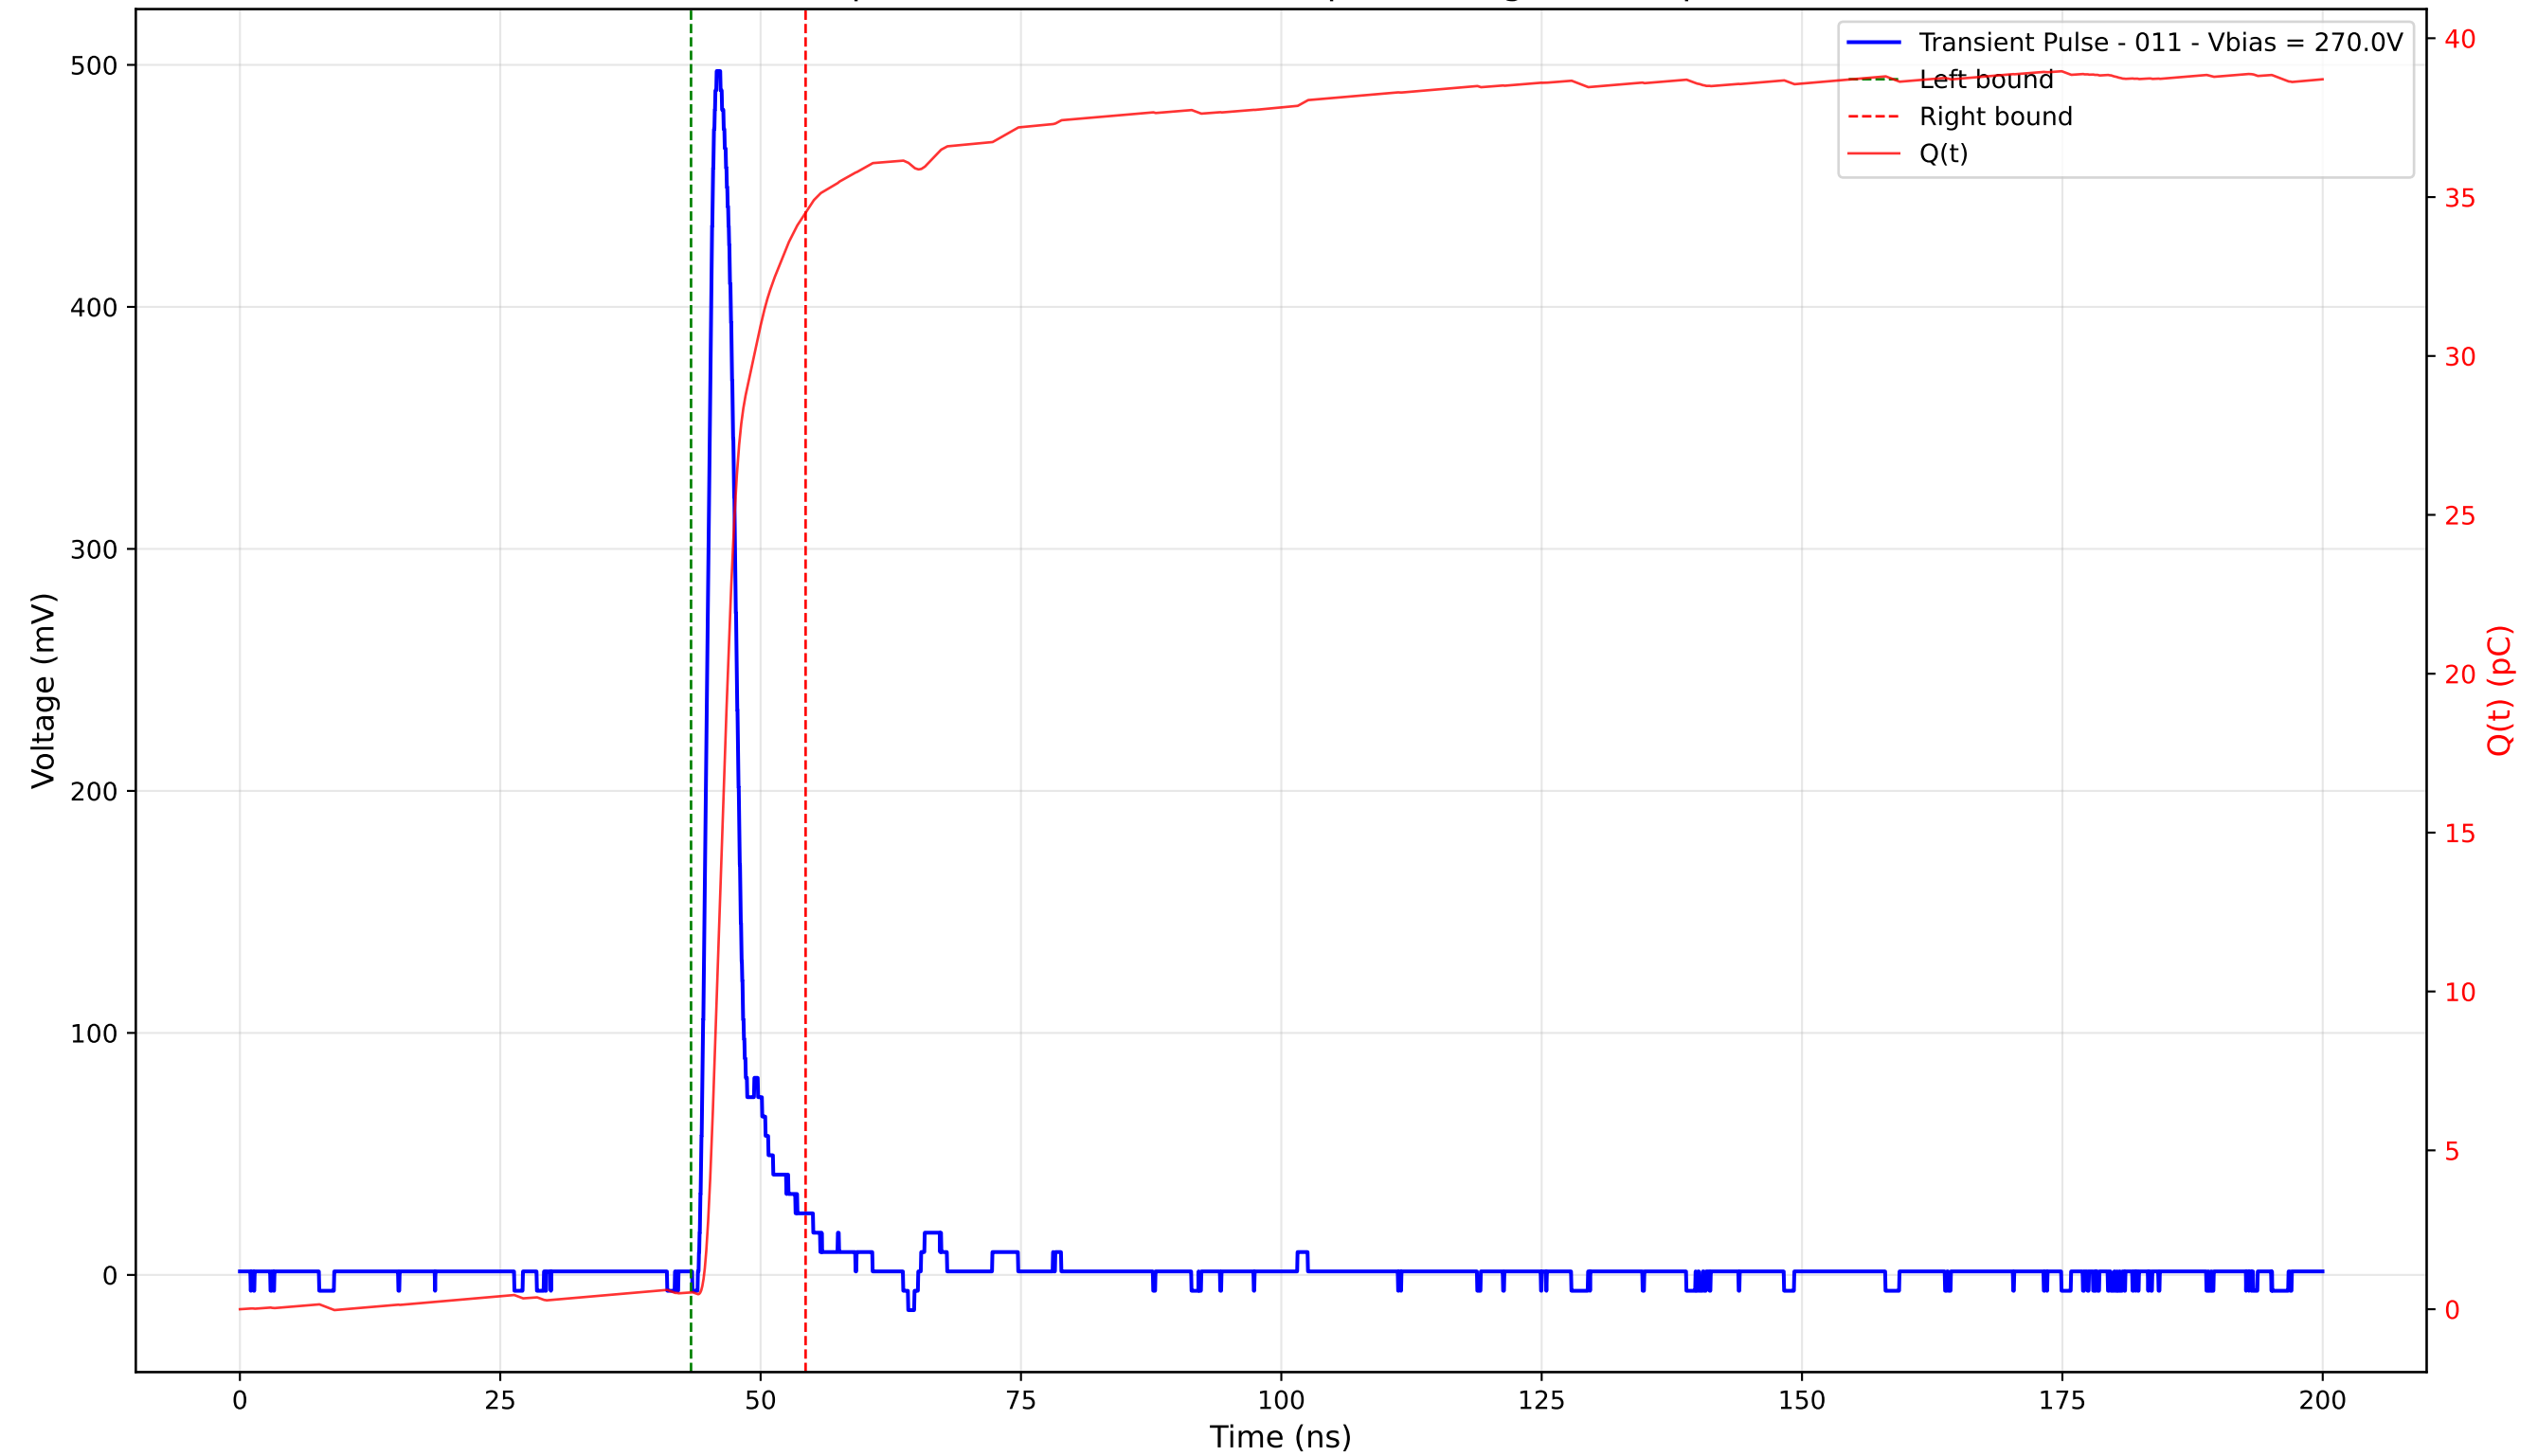


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 33.74 pC - Rise Time: 1.12 ns

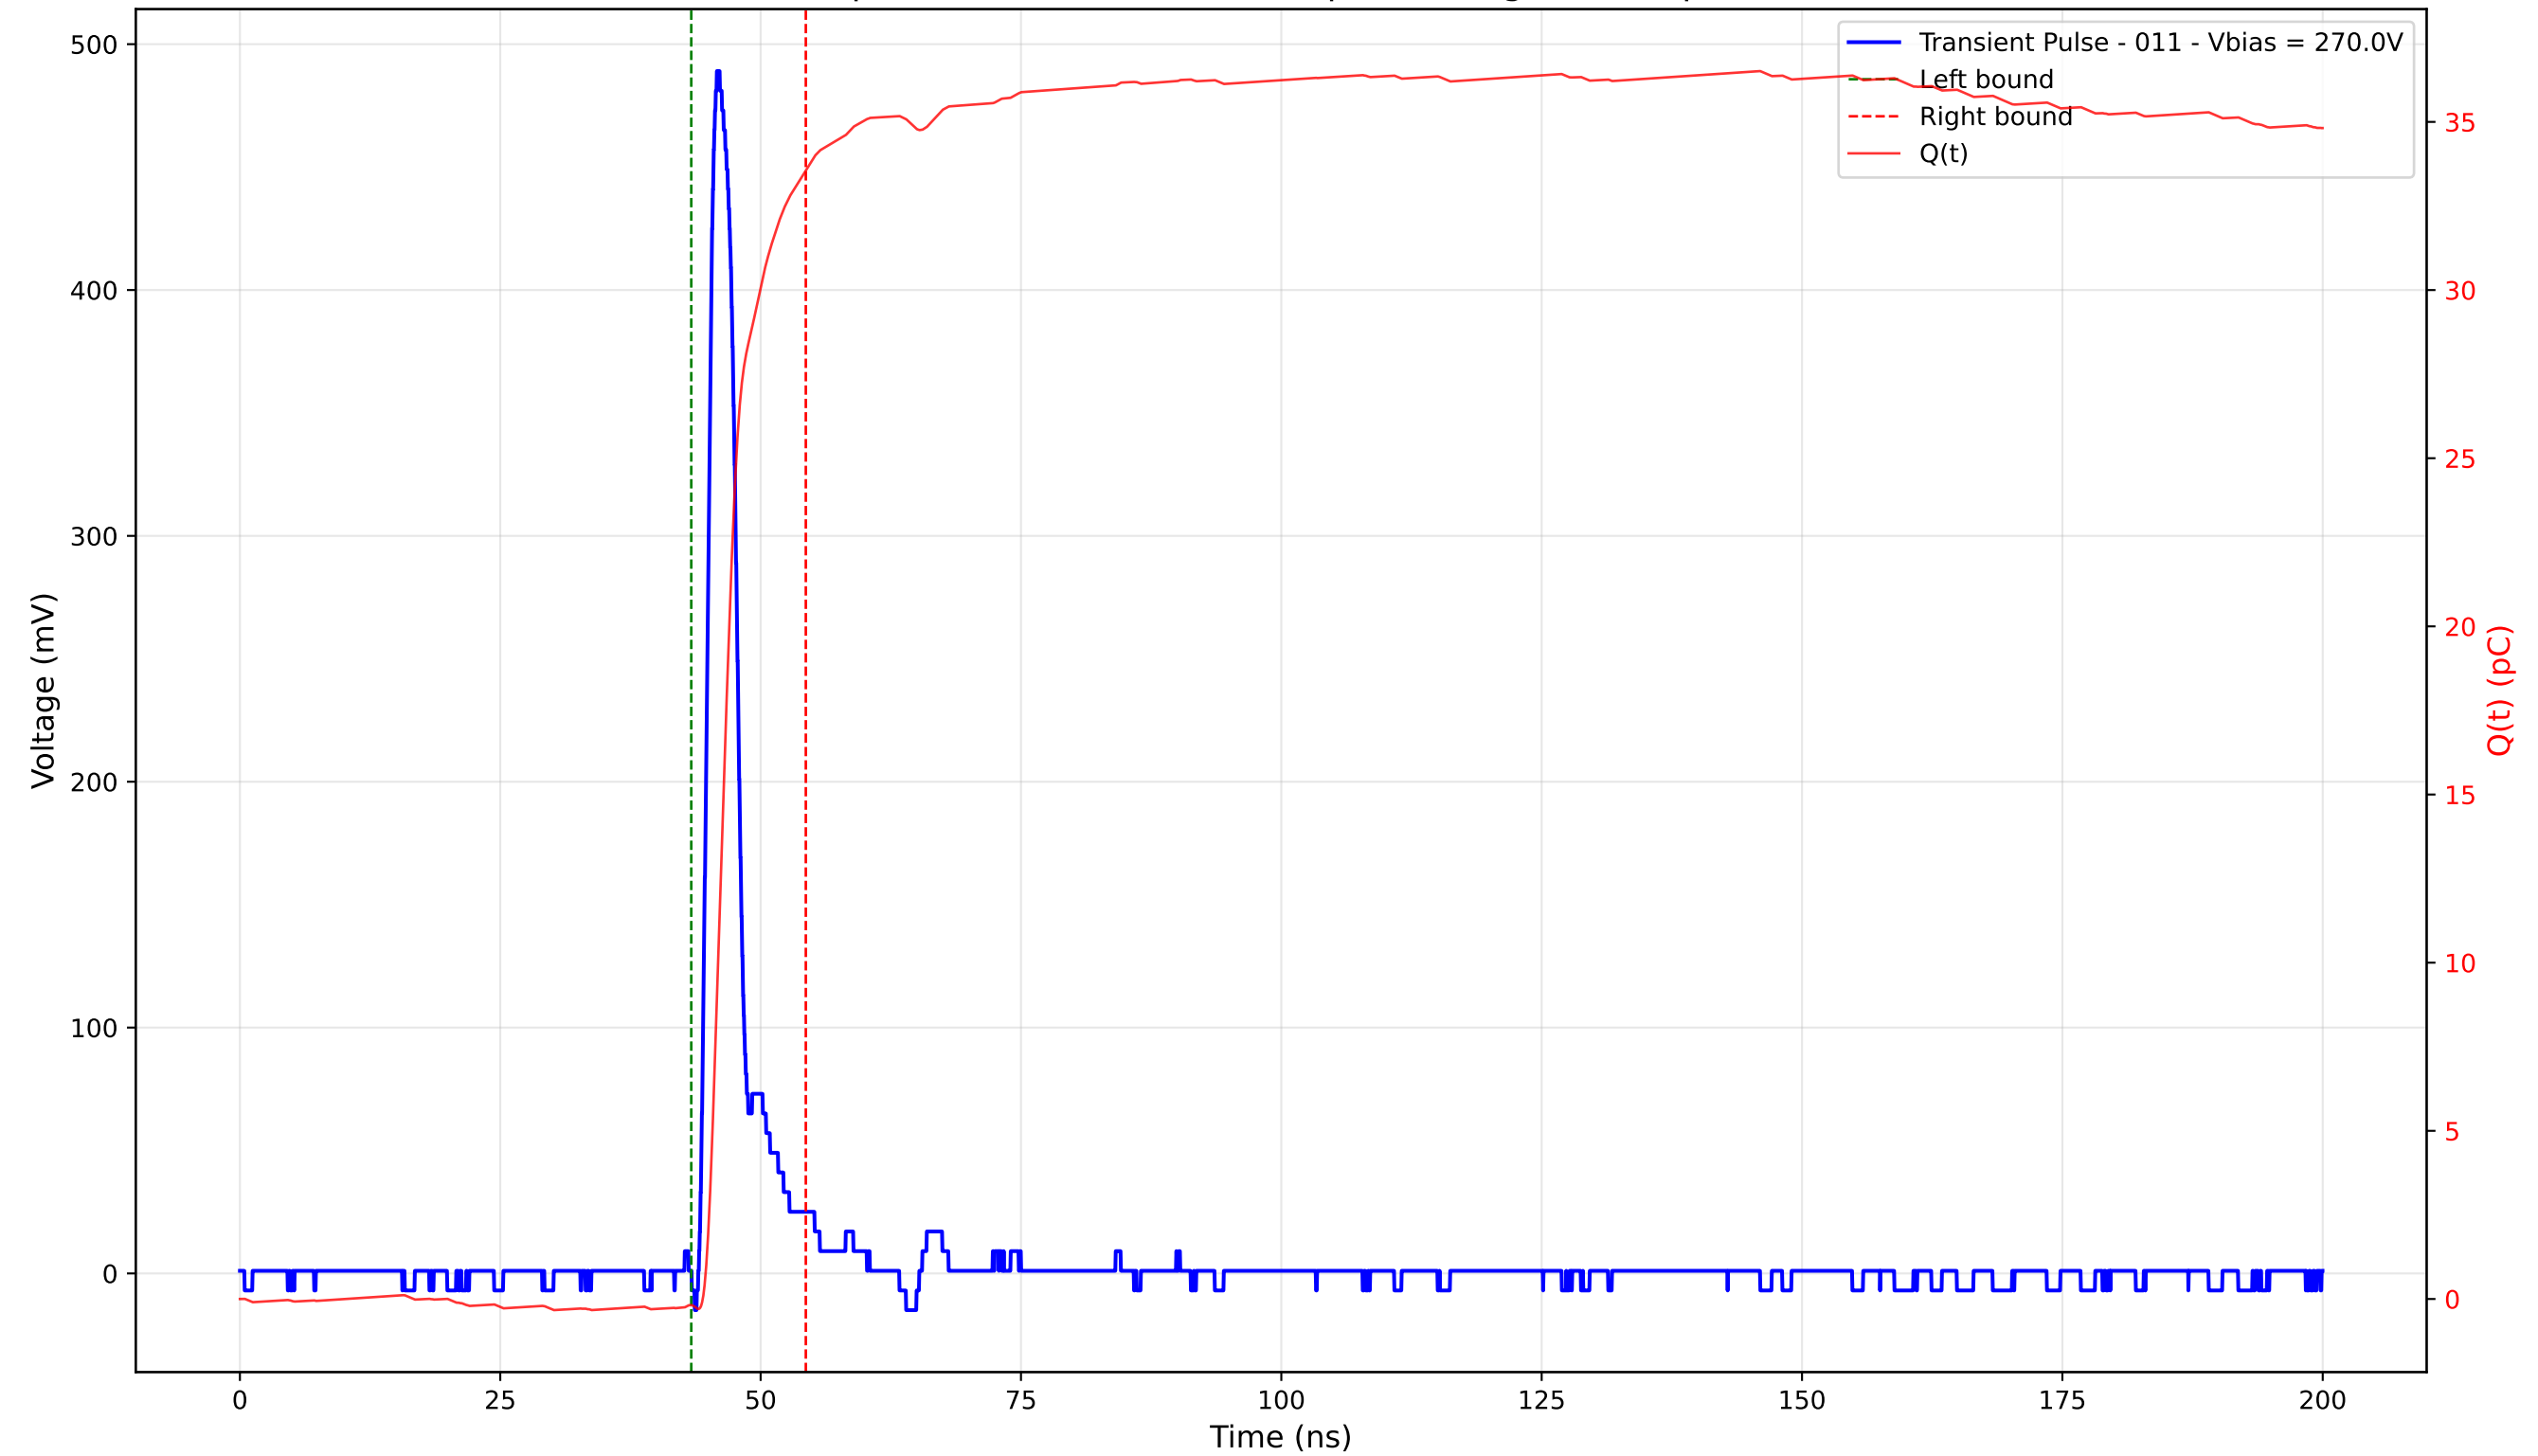


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 33.56 pC - Rise Time: 1.15 ns

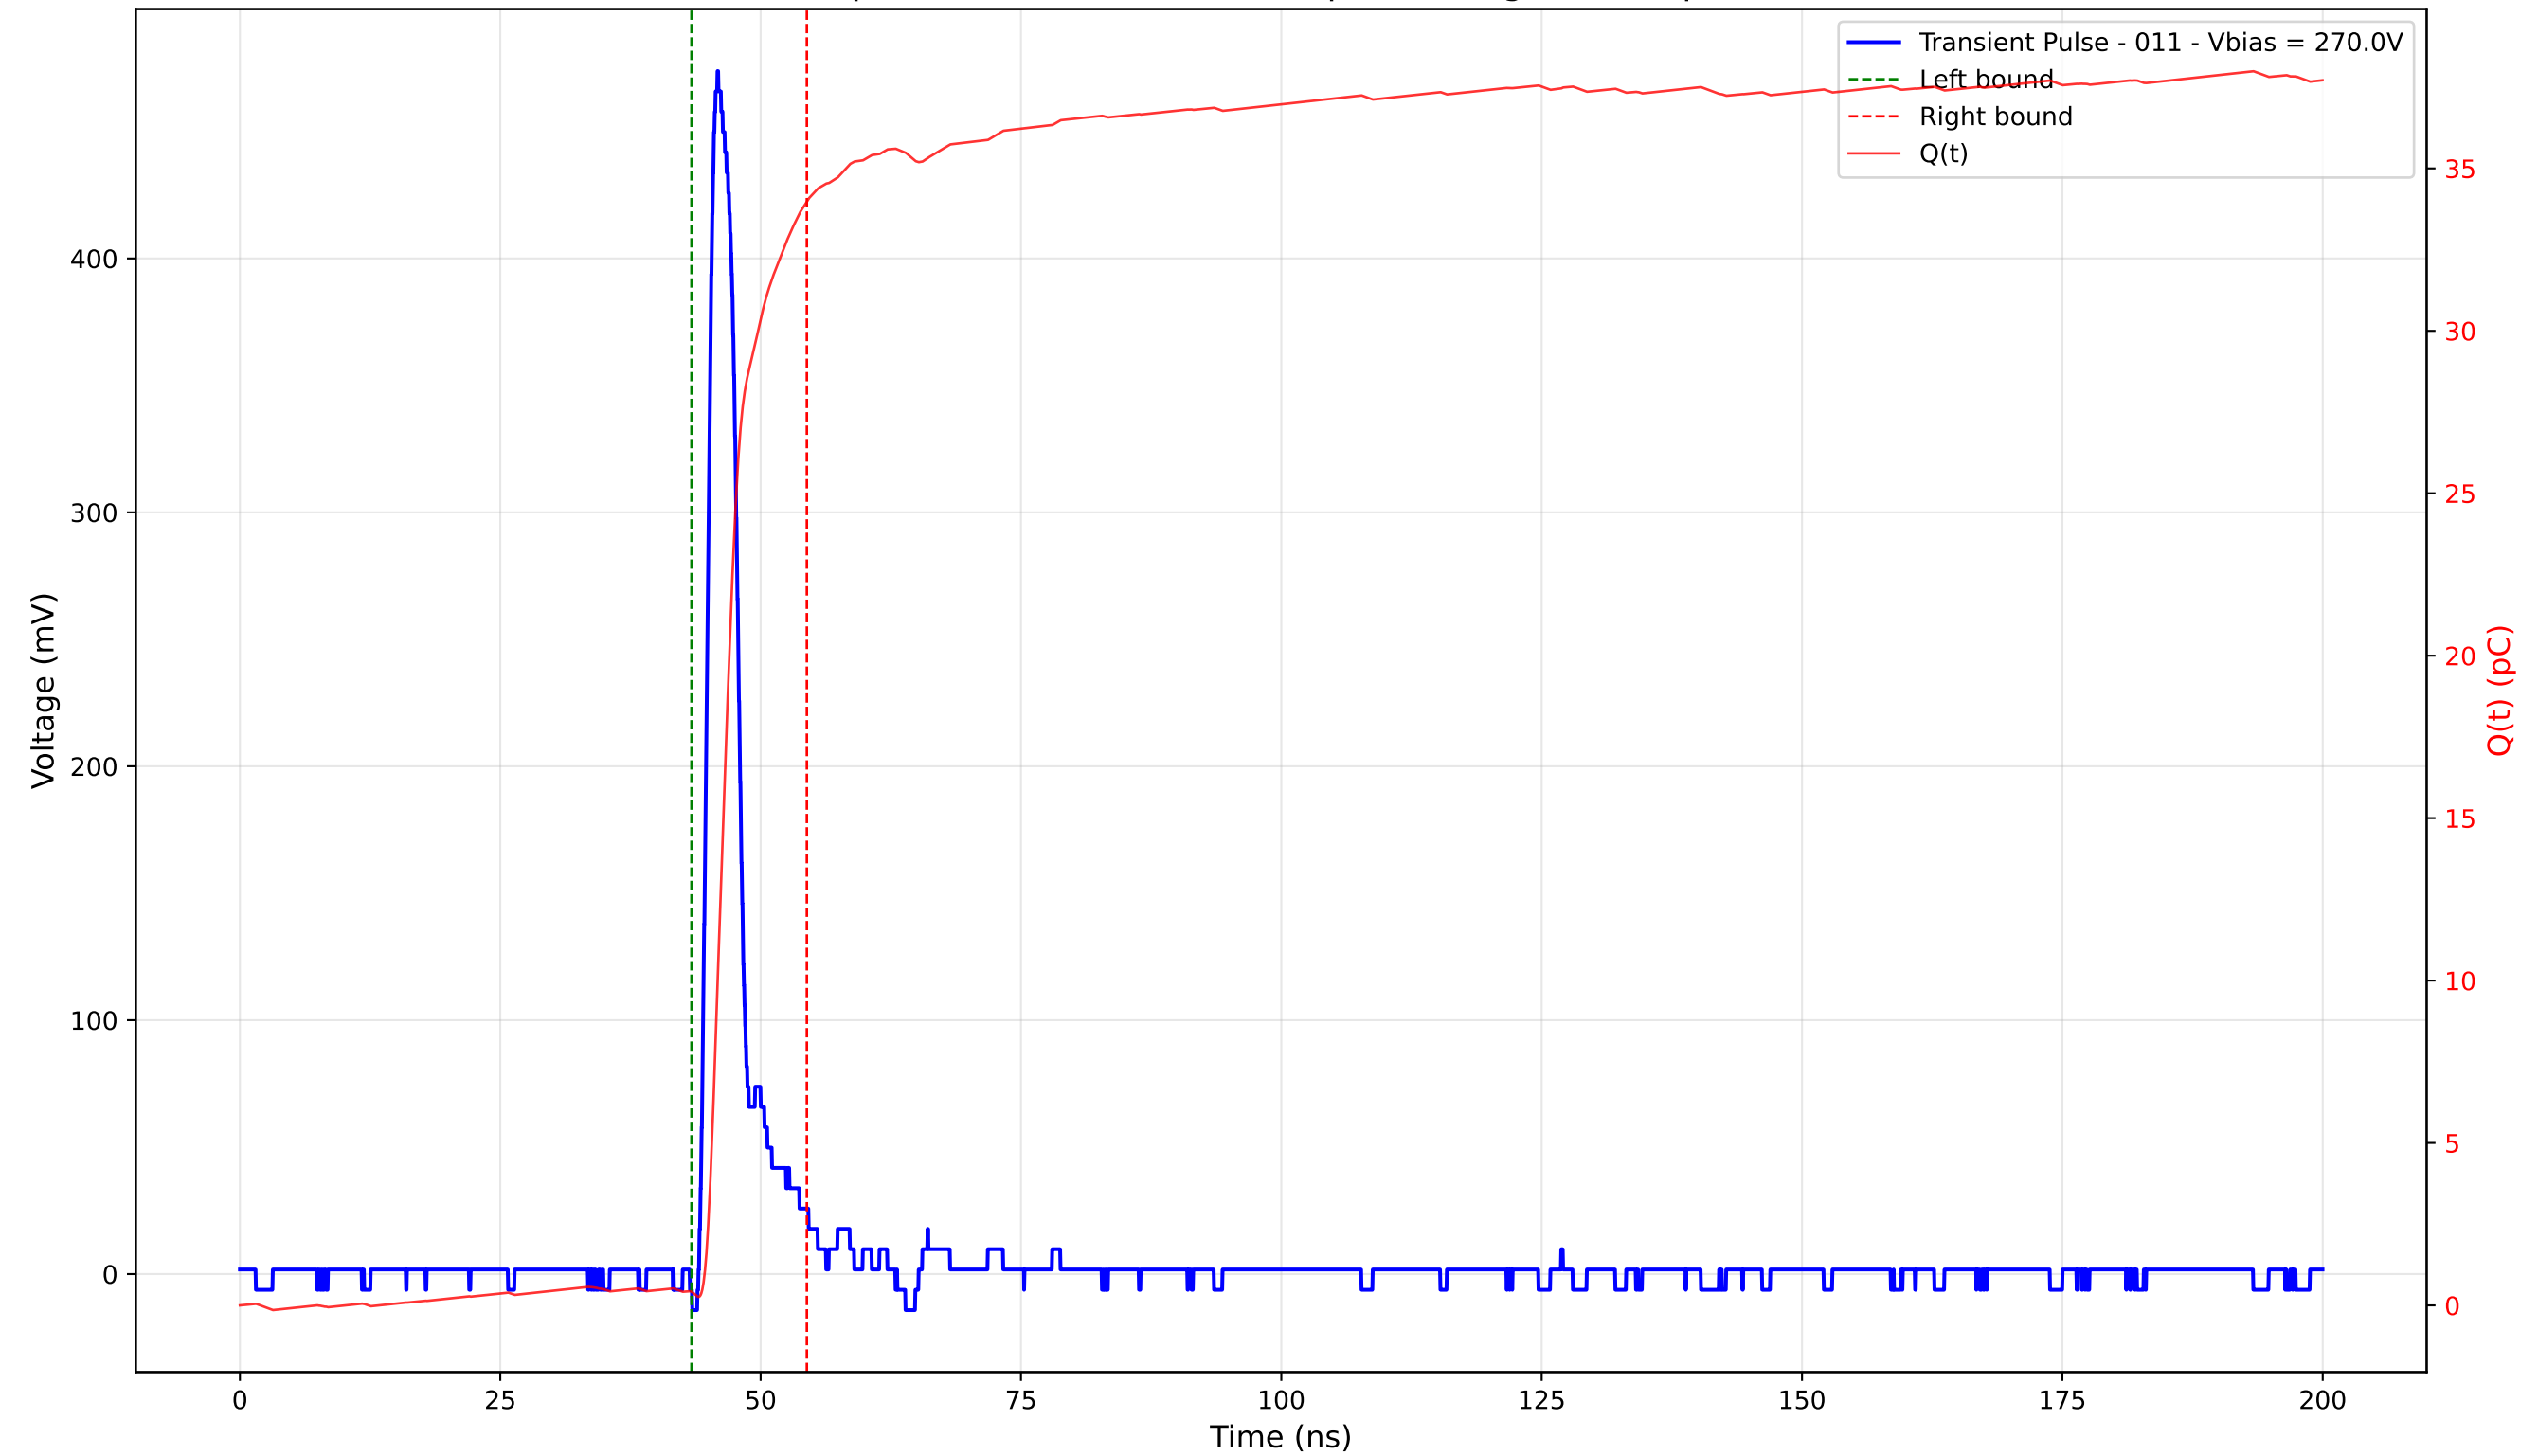


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 33.52 pC - Rise Time: 1.15 ns

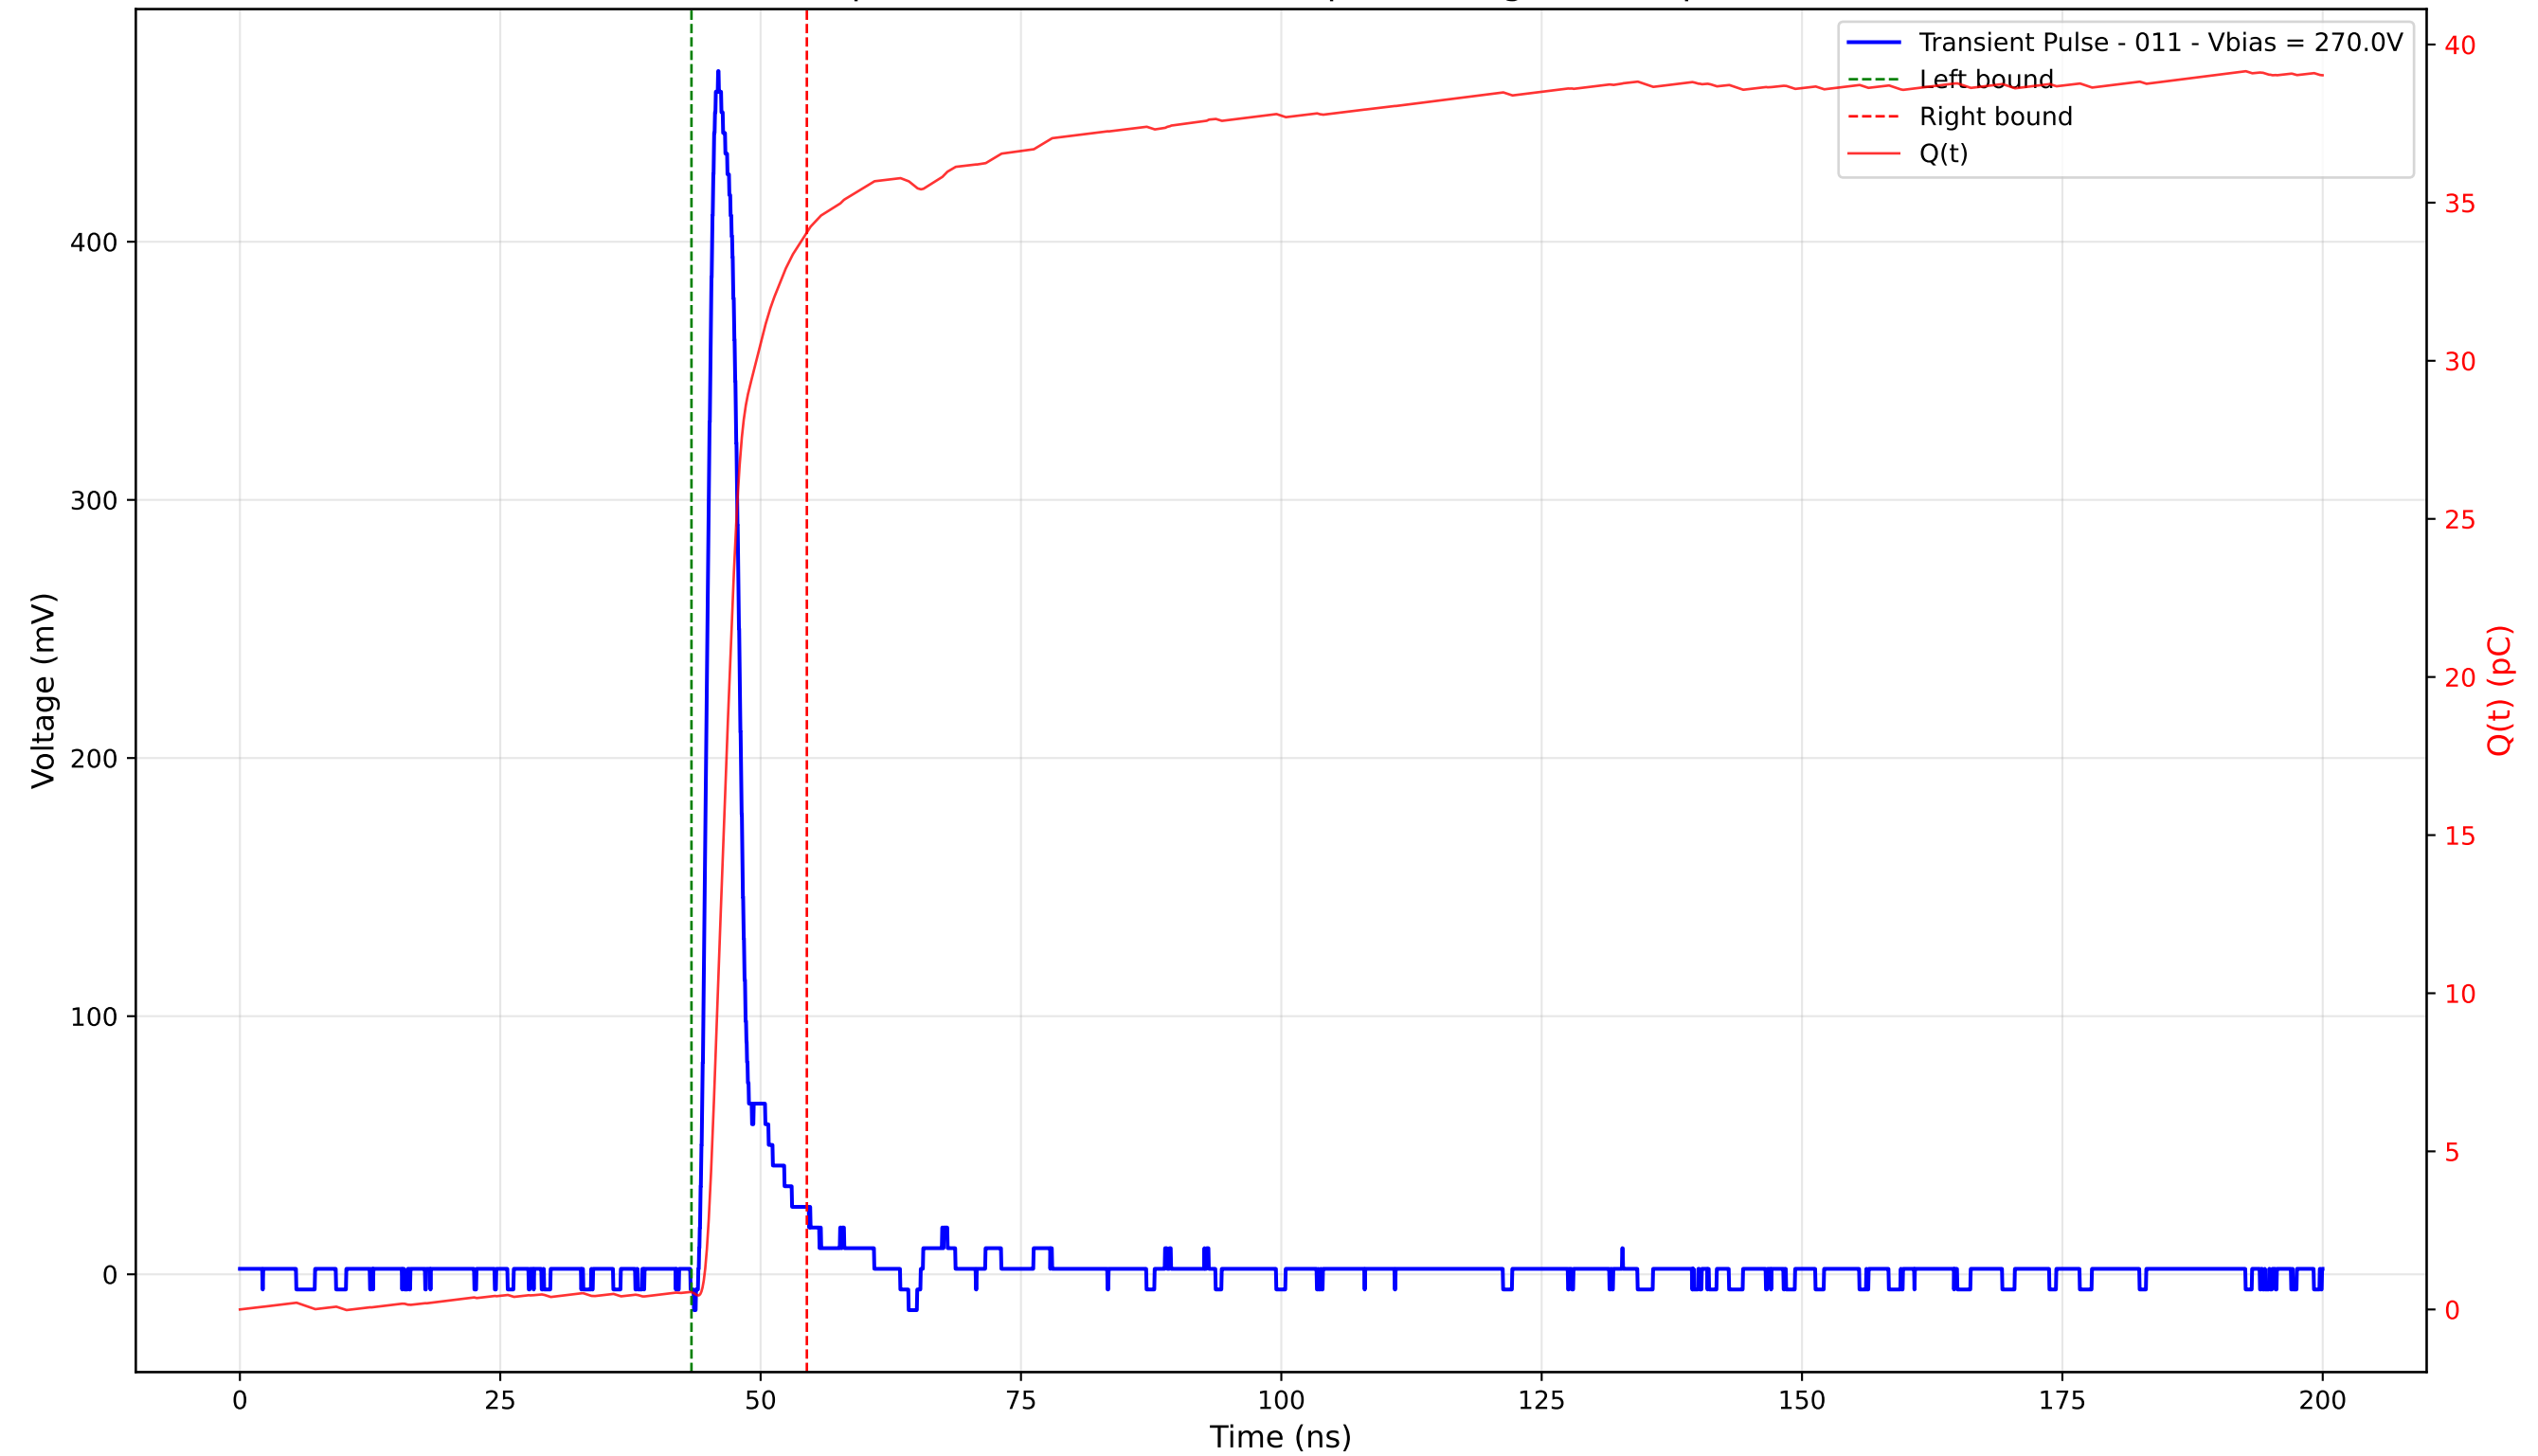


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 33.03 pC - Rise Time: 1.11 ns

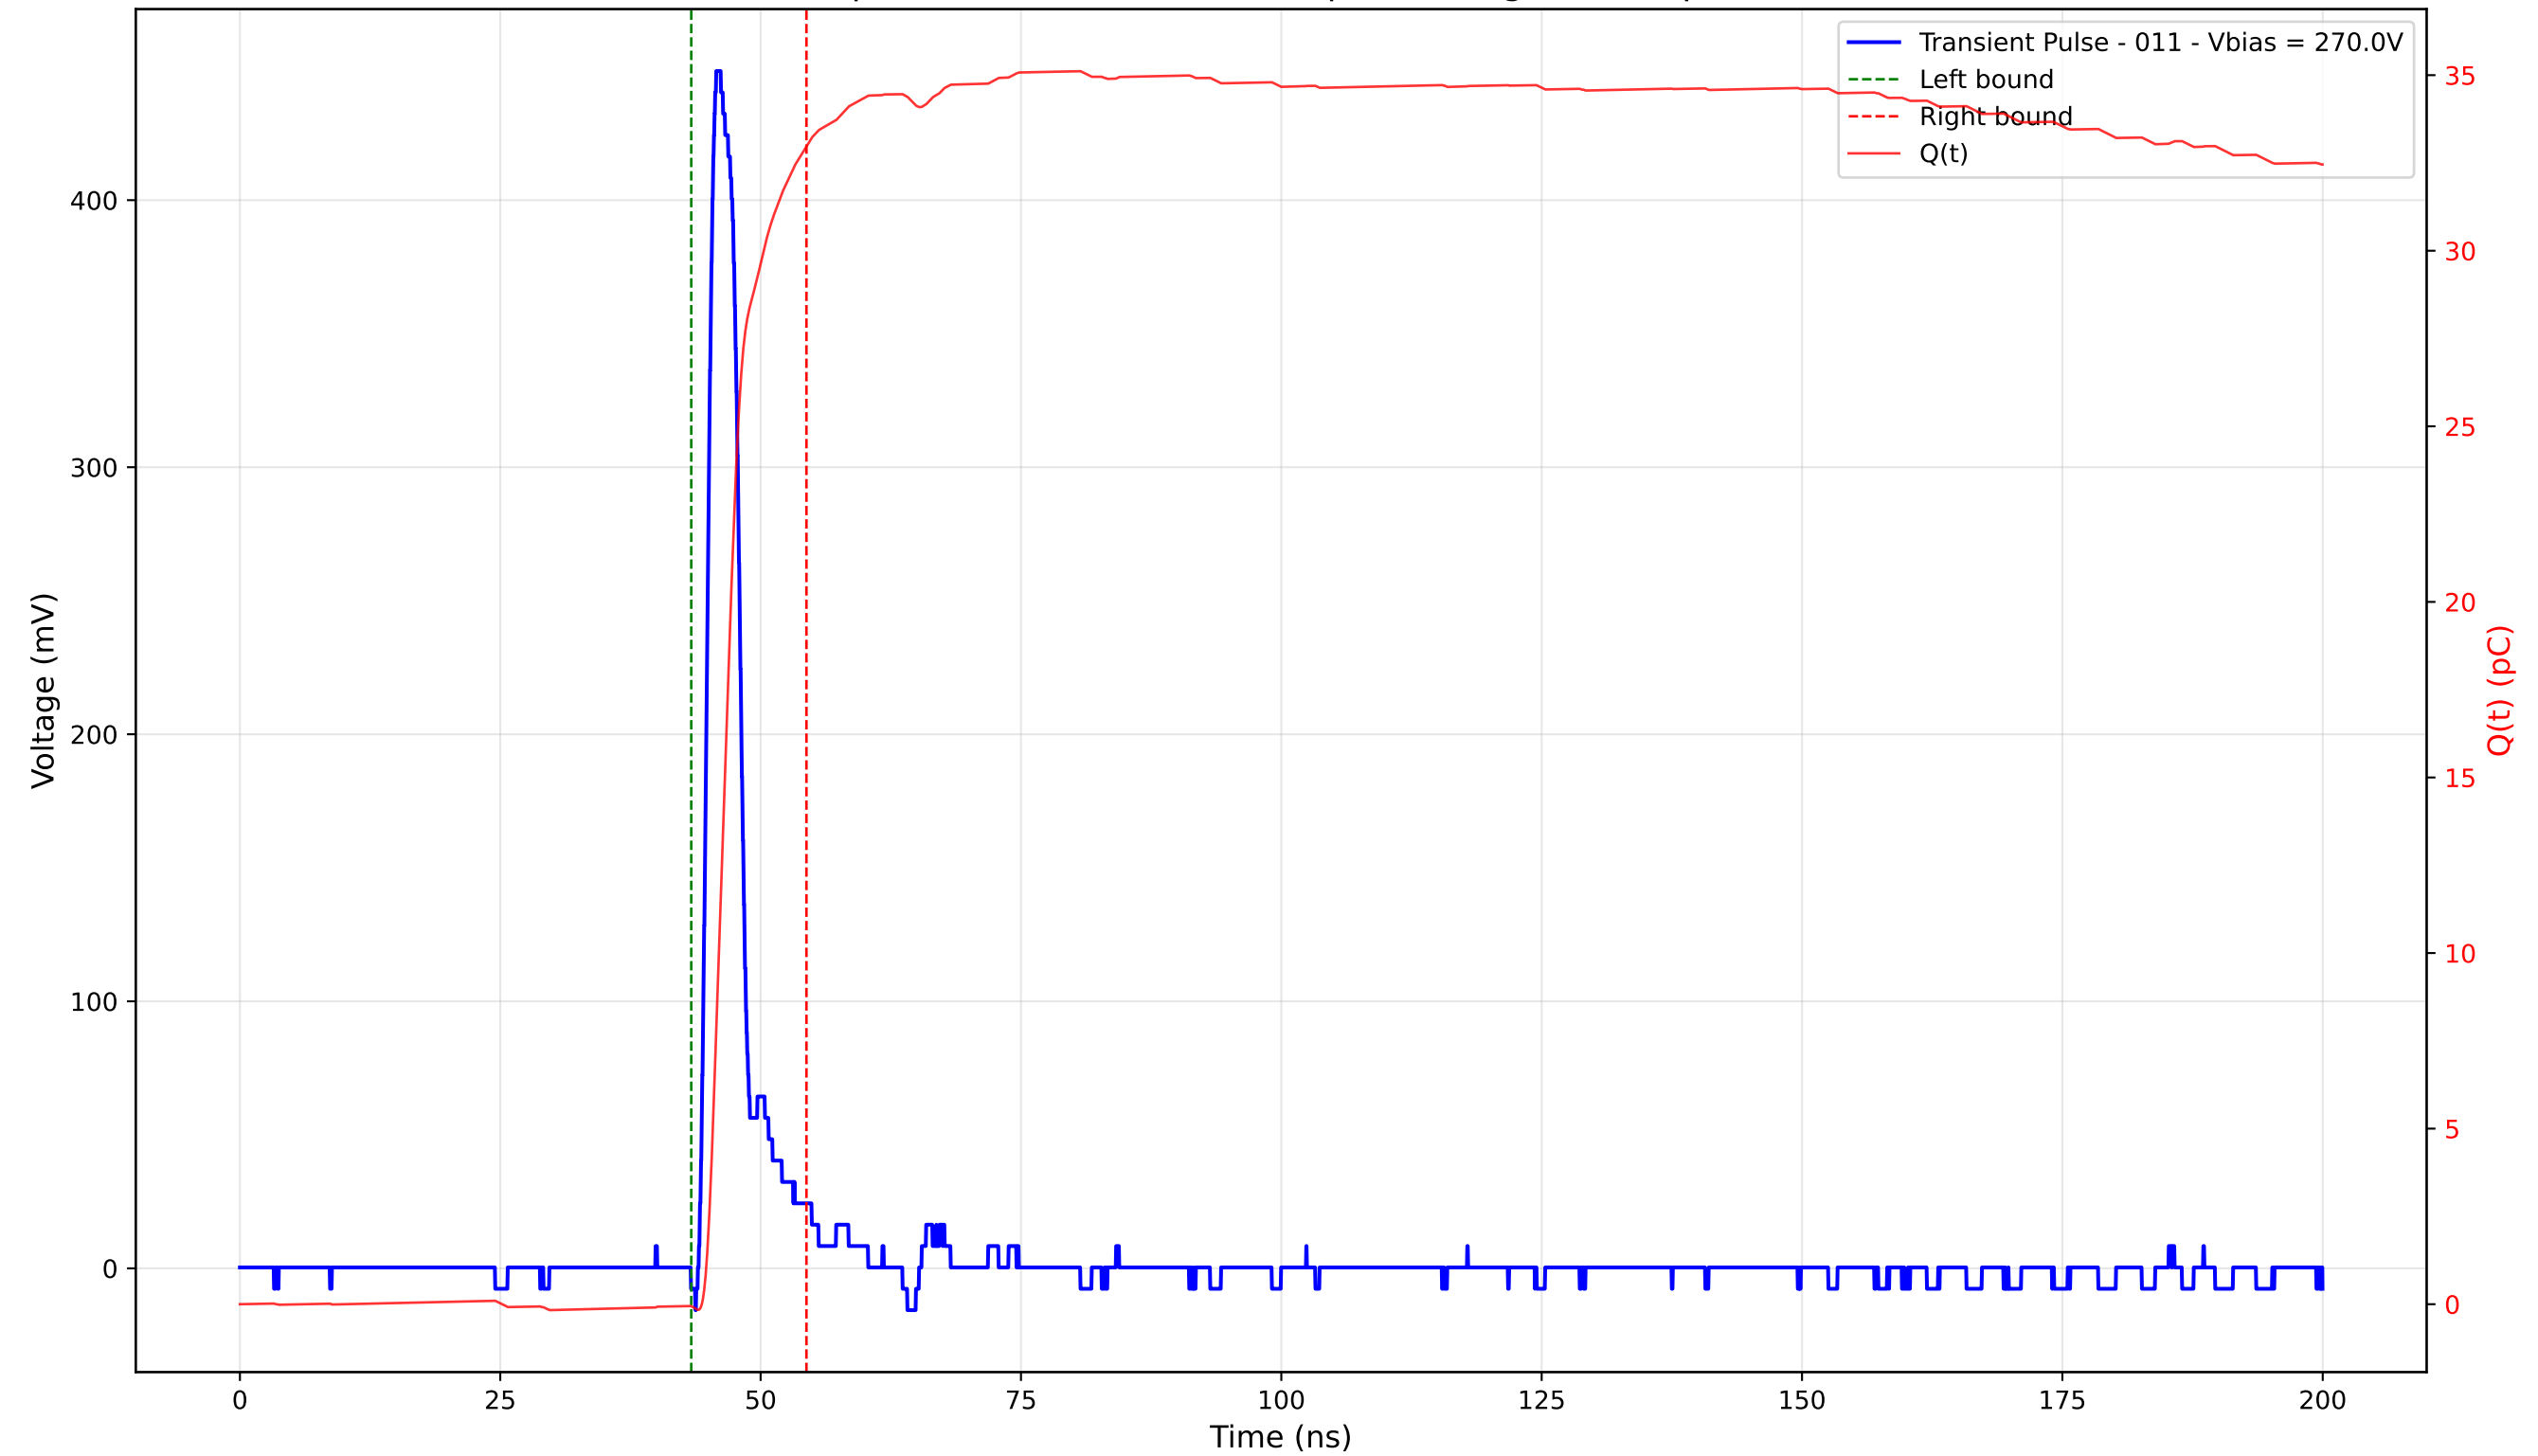


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 33.59 pC - Rise Time: 1.10 ns

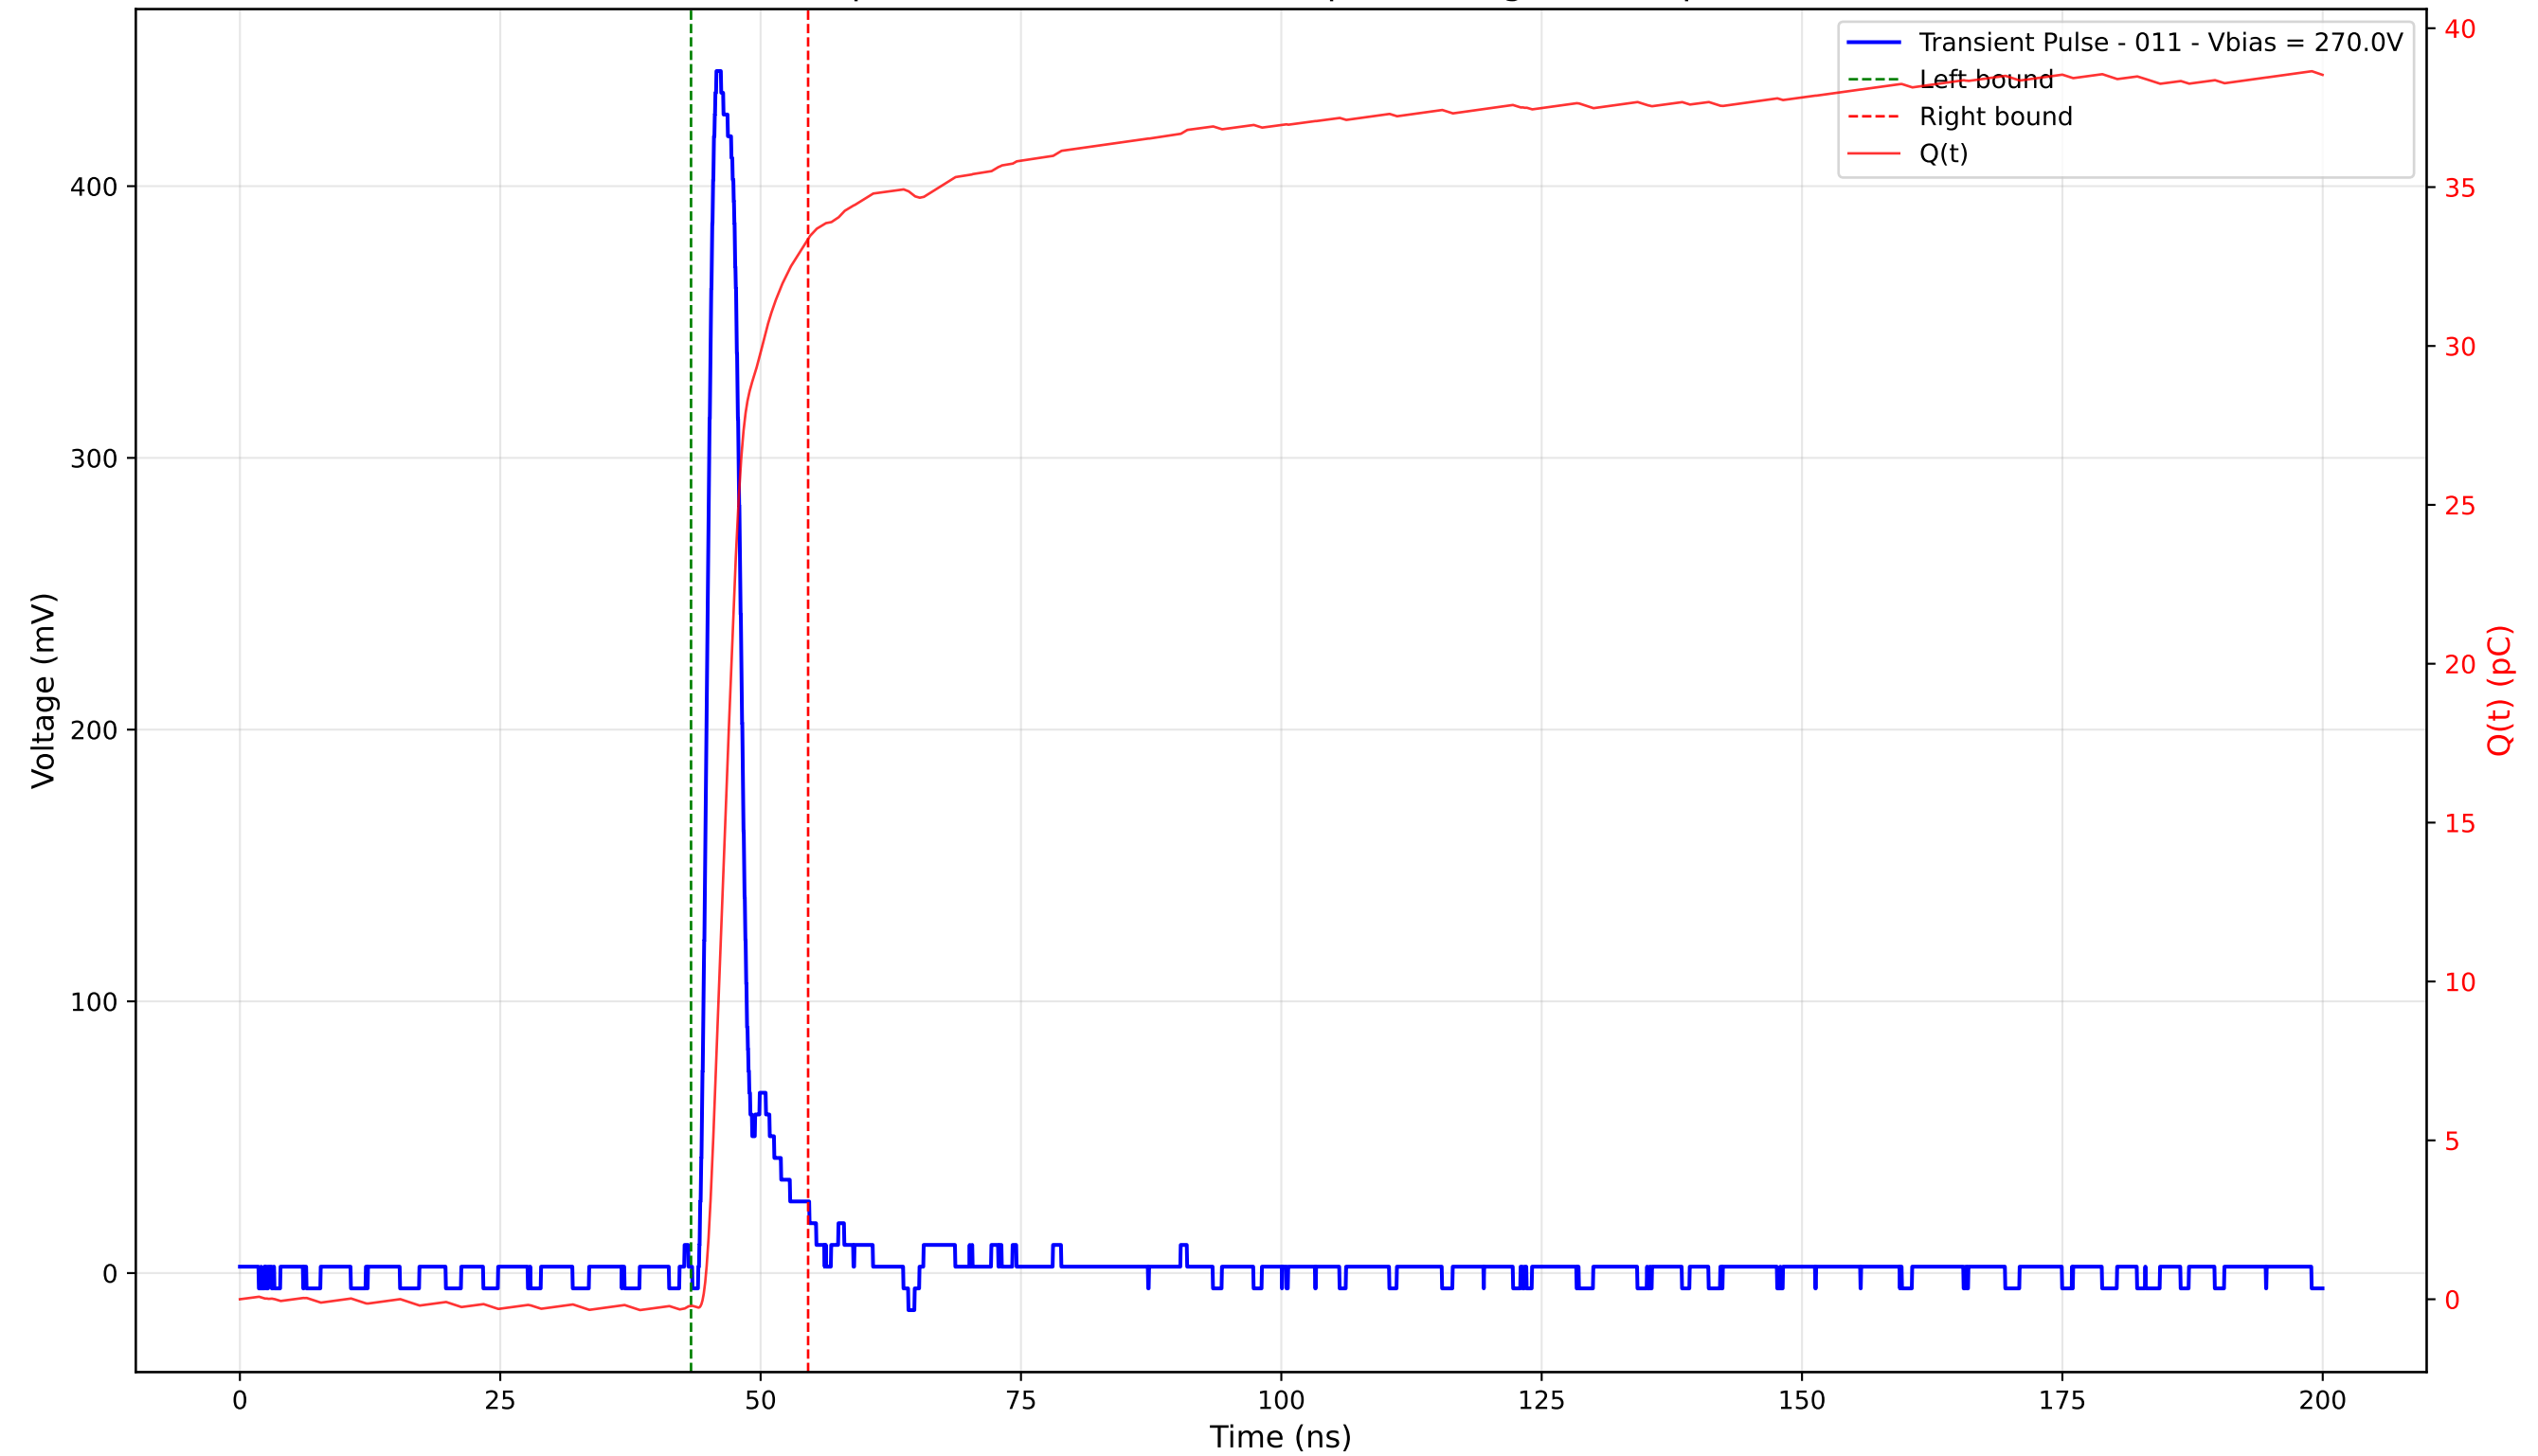


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 33.59 pC - Rise Time: 1.12 ns

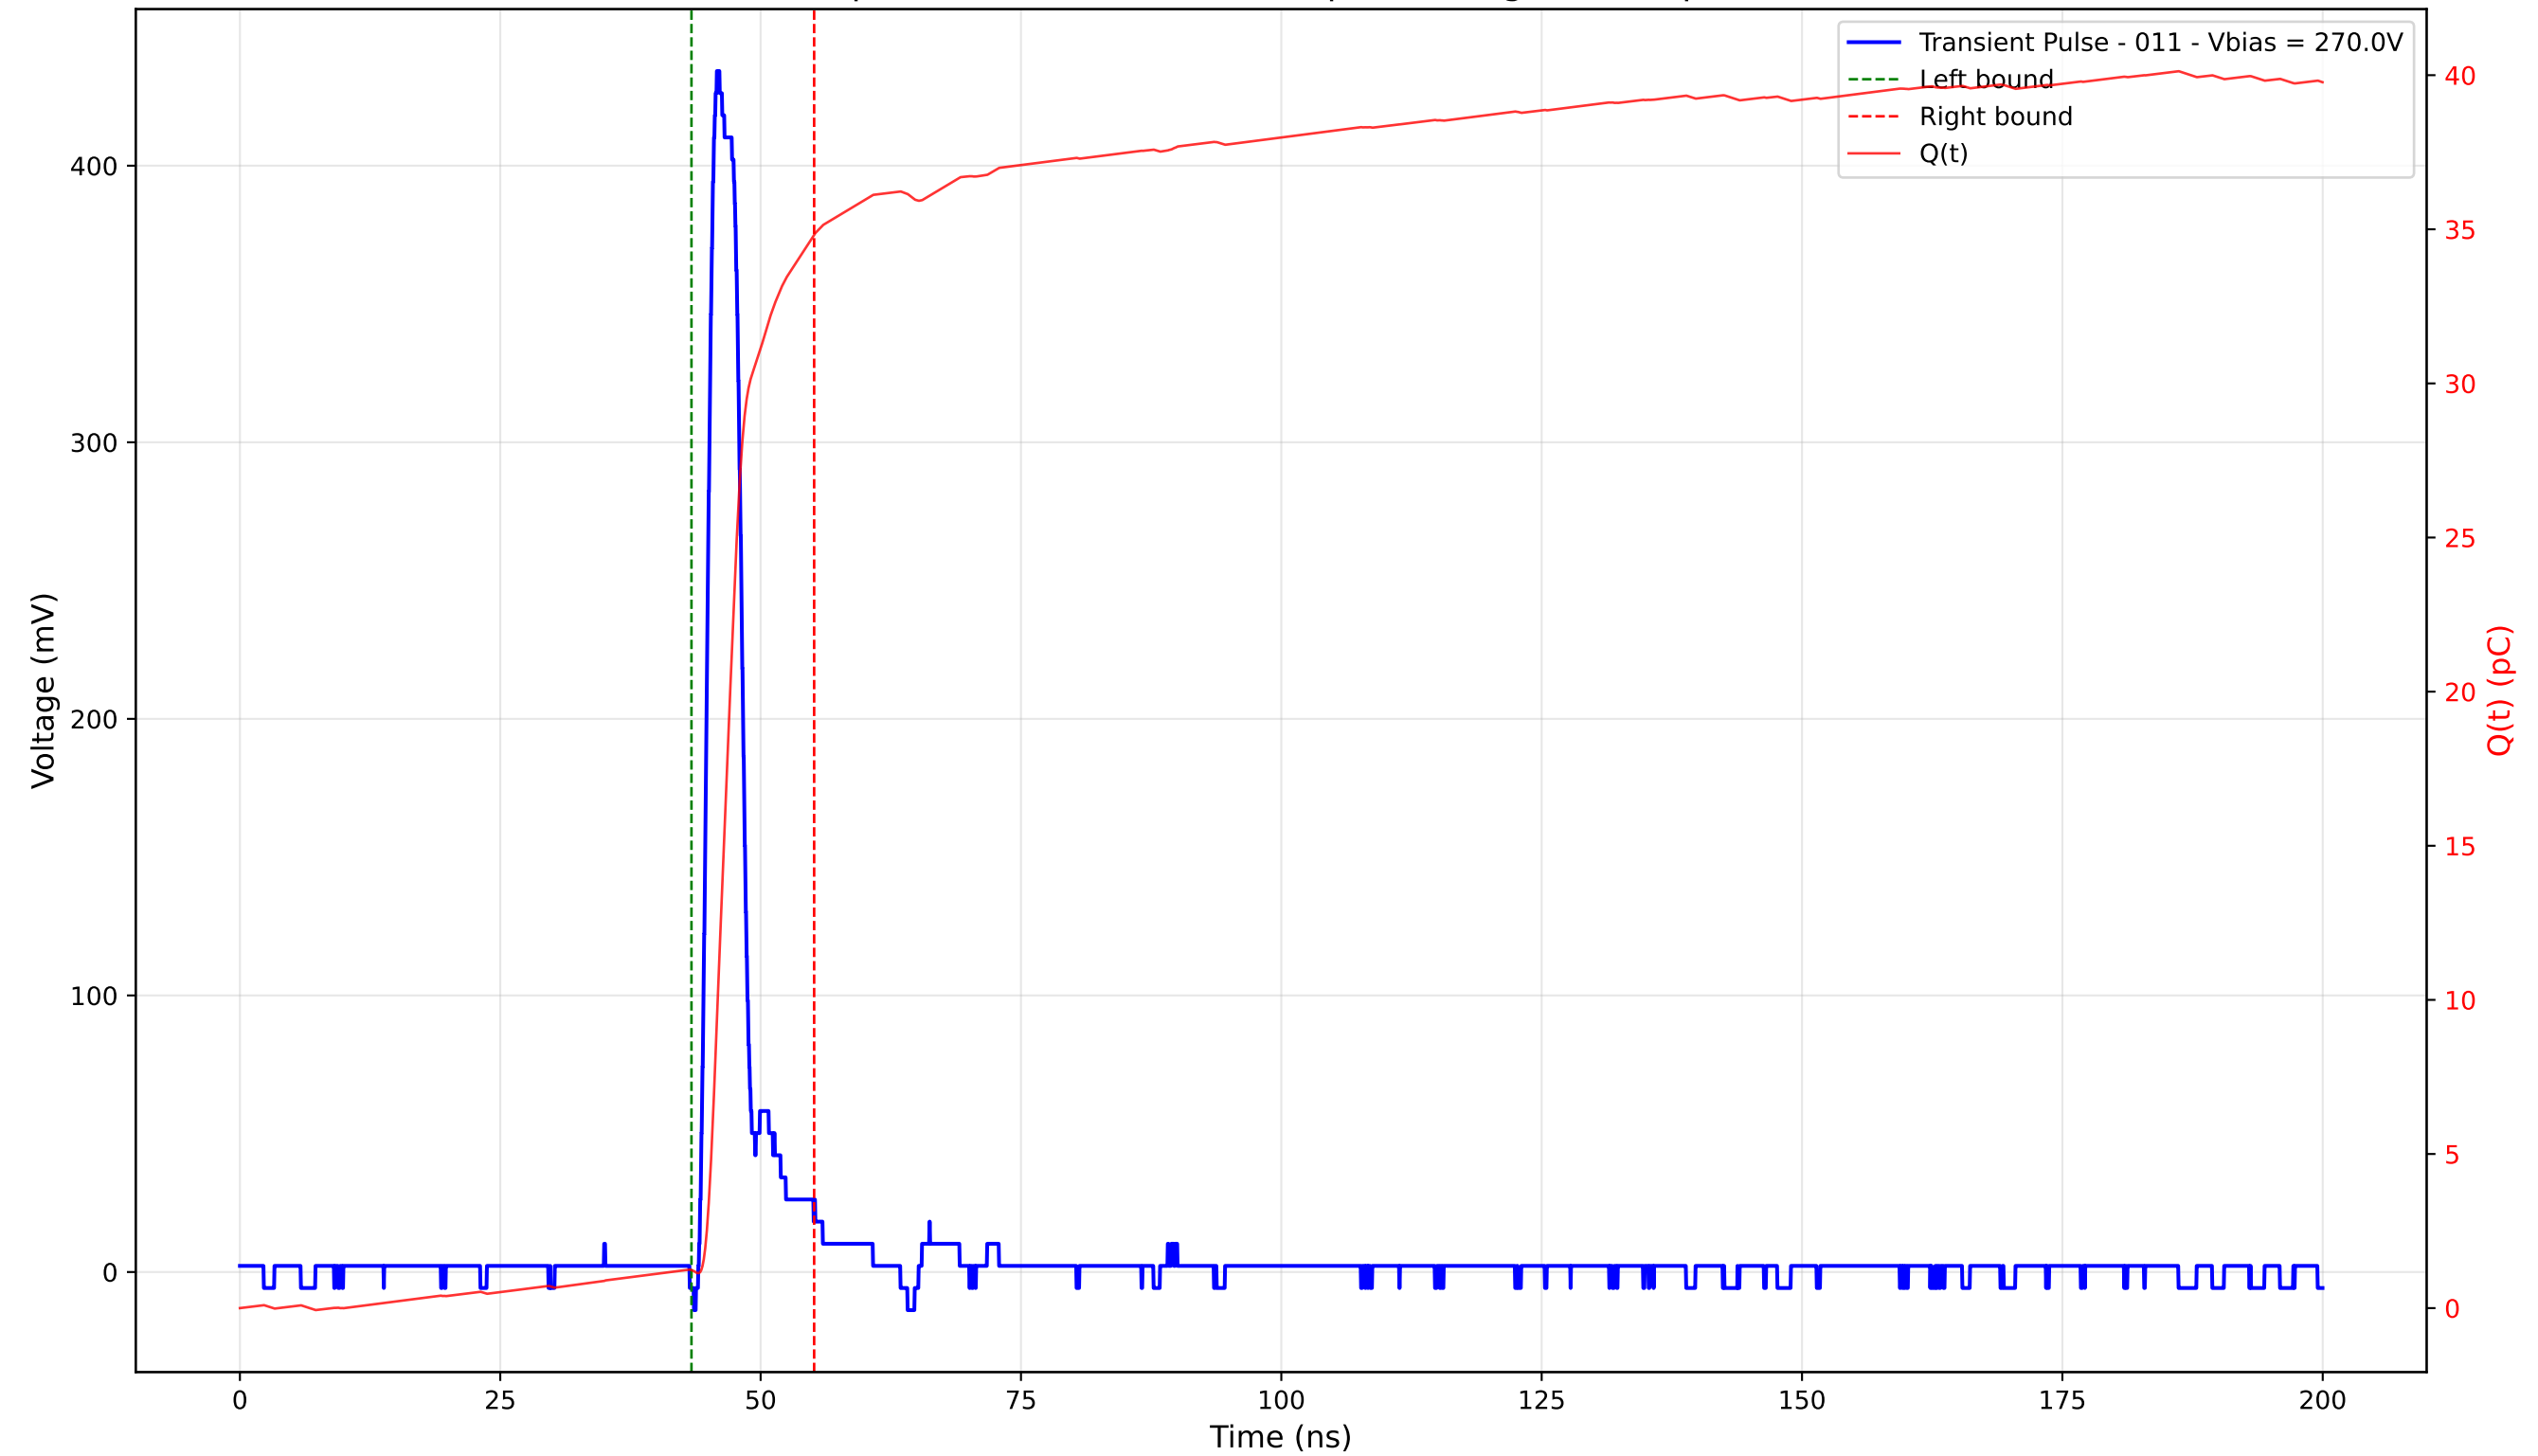


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 33.11 pC - Rise Time: 1.12 ns

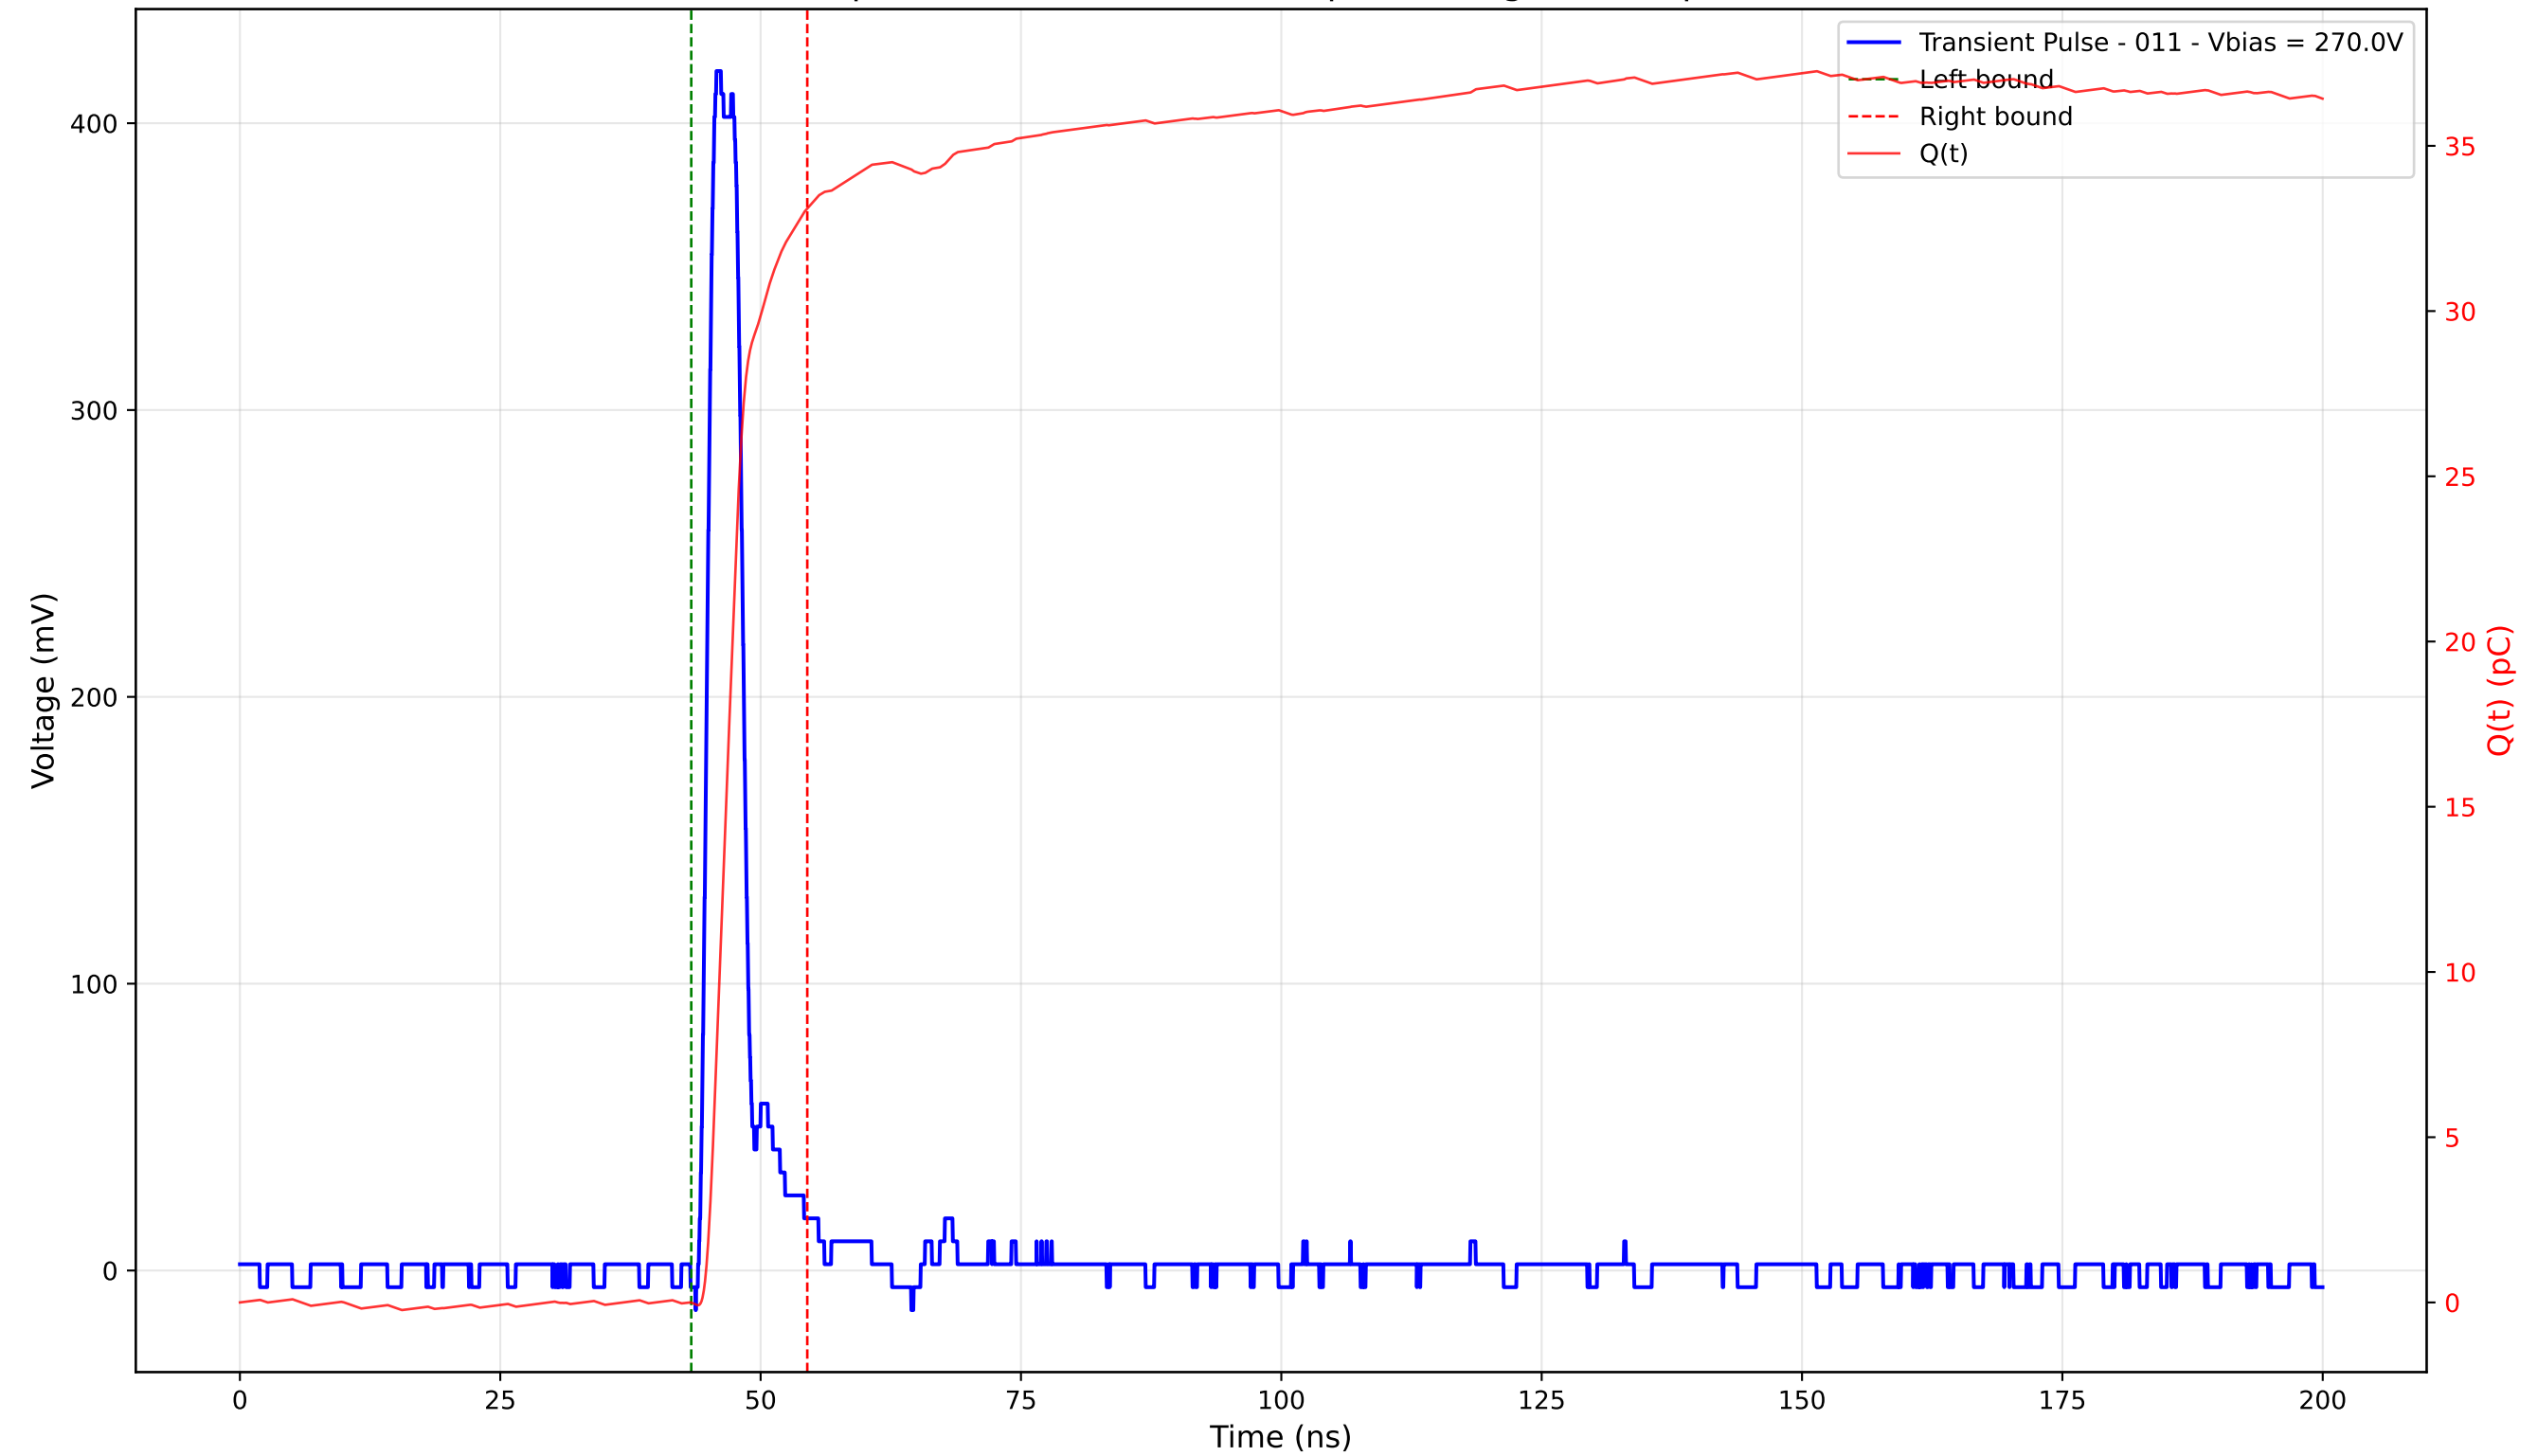


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 32.77 pC - Rise Time: 1.10 ns

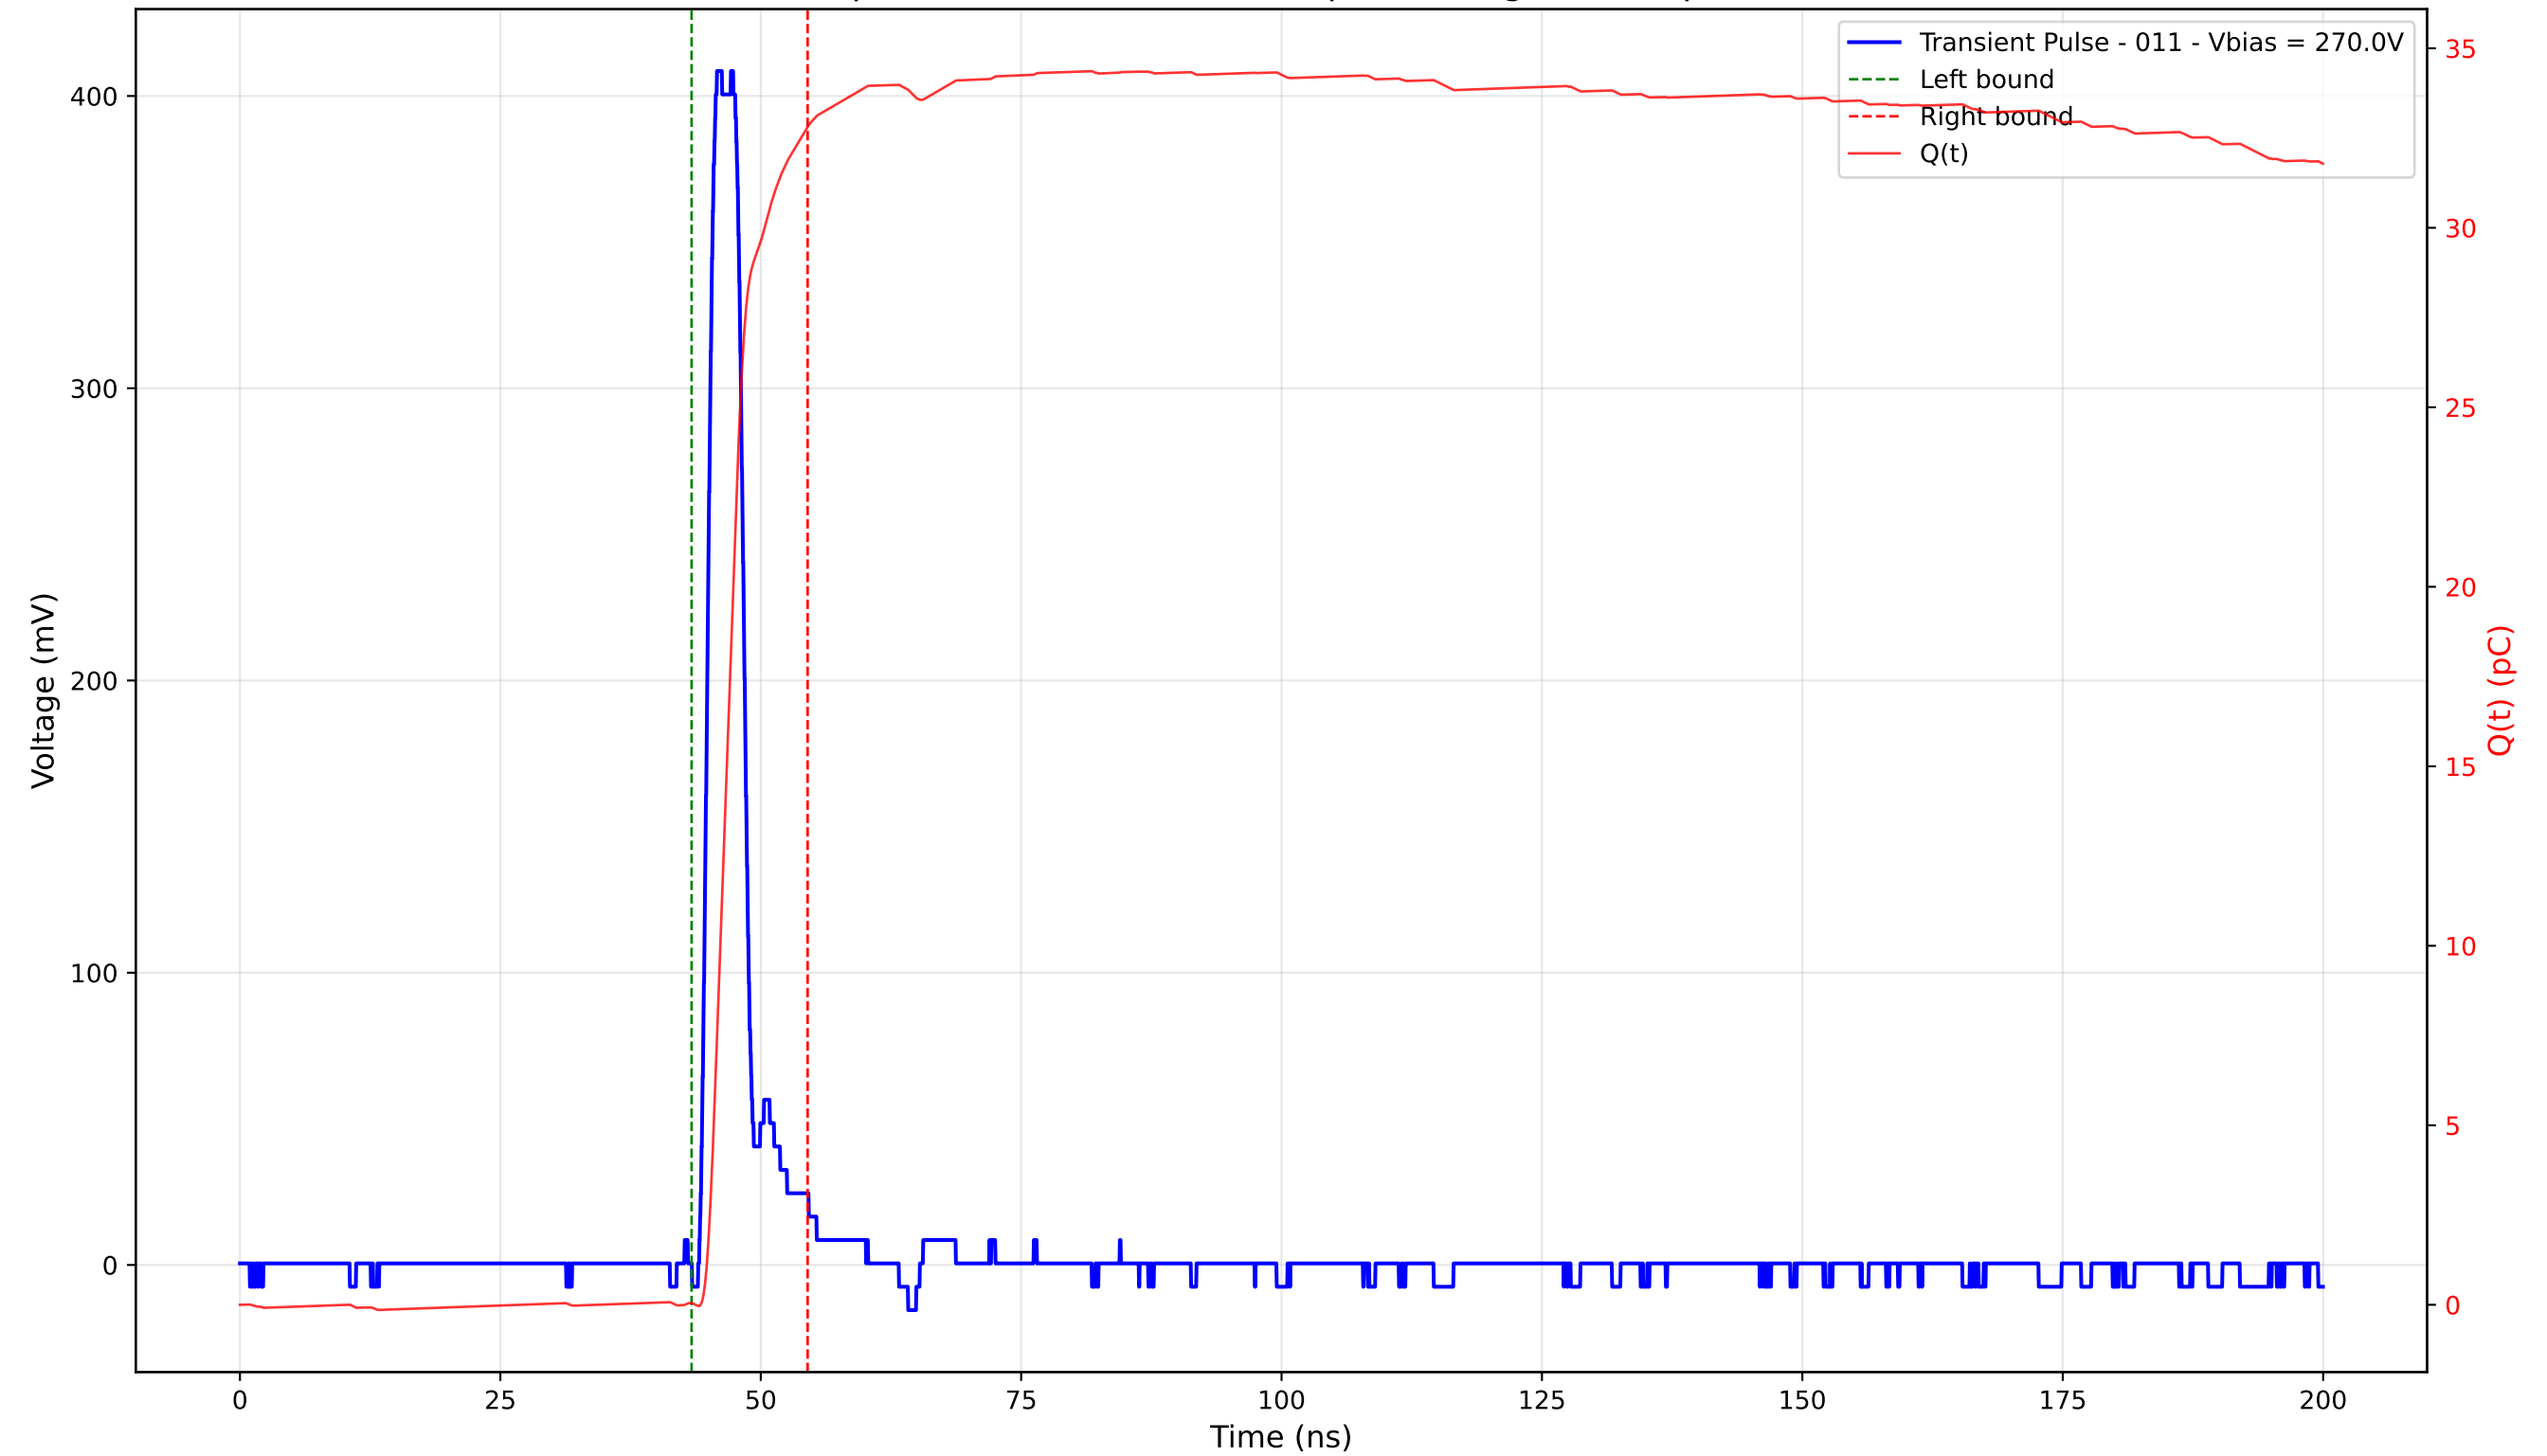


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 32.89 pC - Rise Time: 1.12 ns

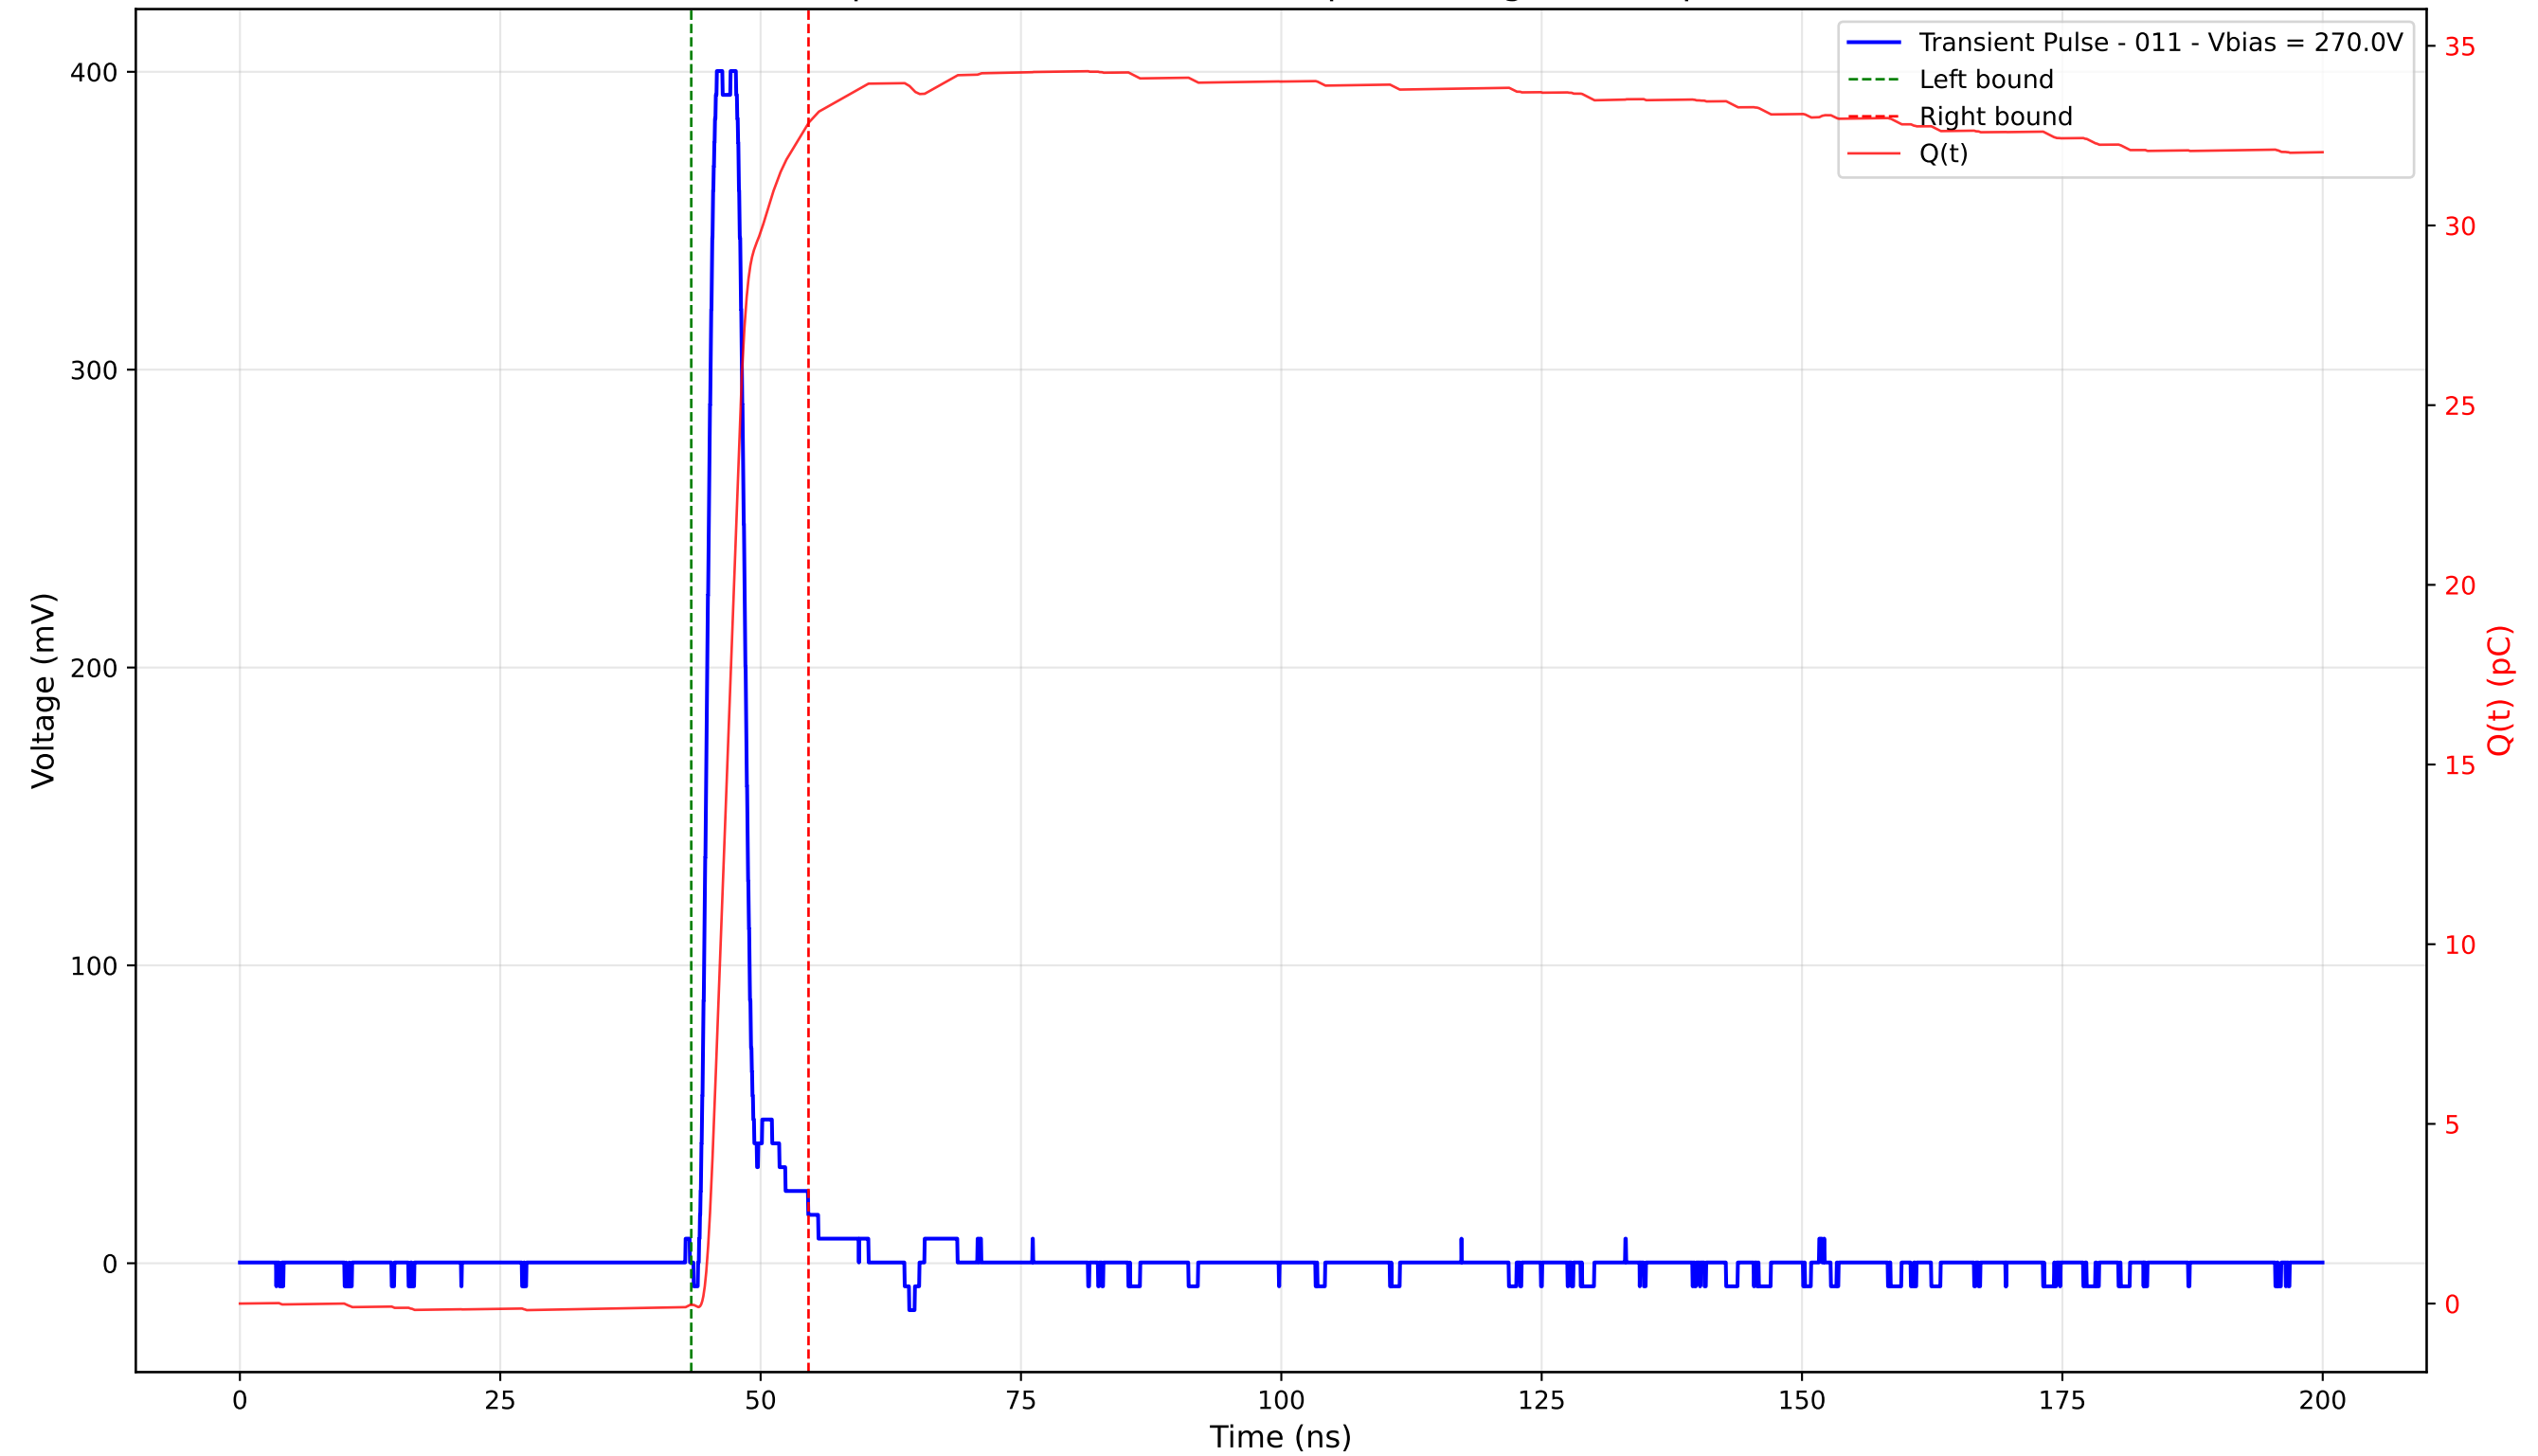


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 33.19 pC - Rise Time: 1.22 ns

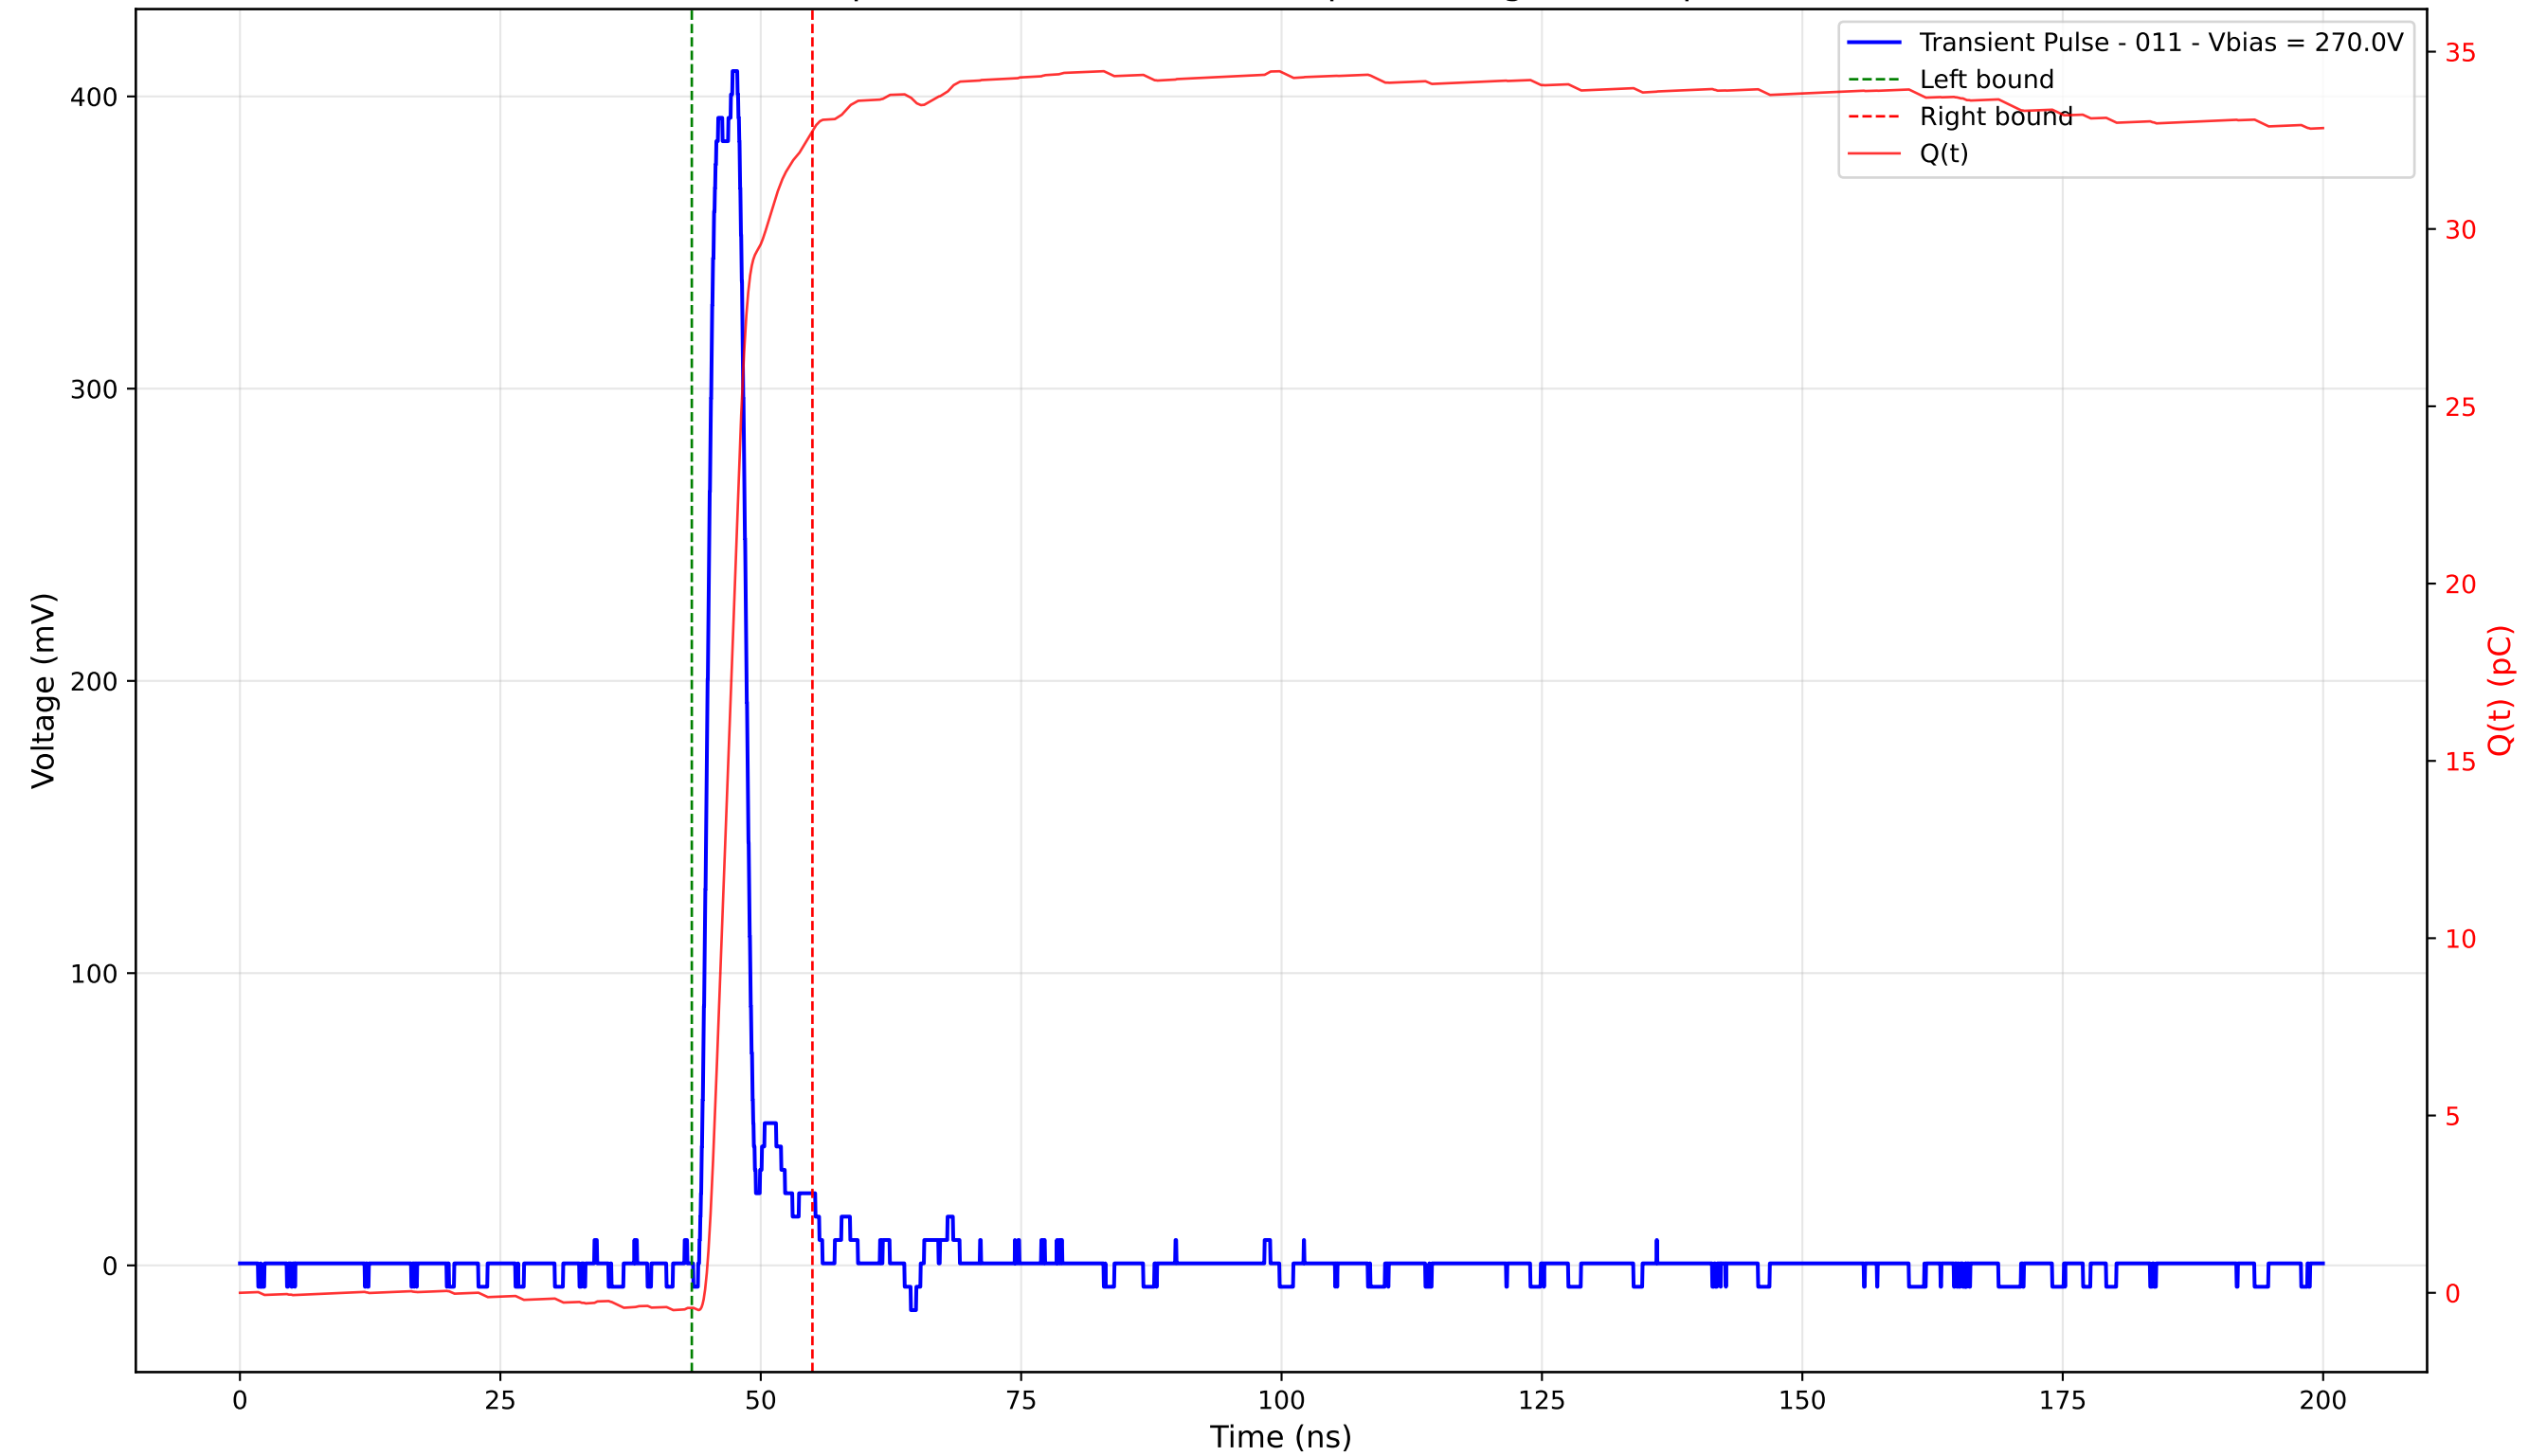


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 33.05 pC - Rise Time: 1.28 ns

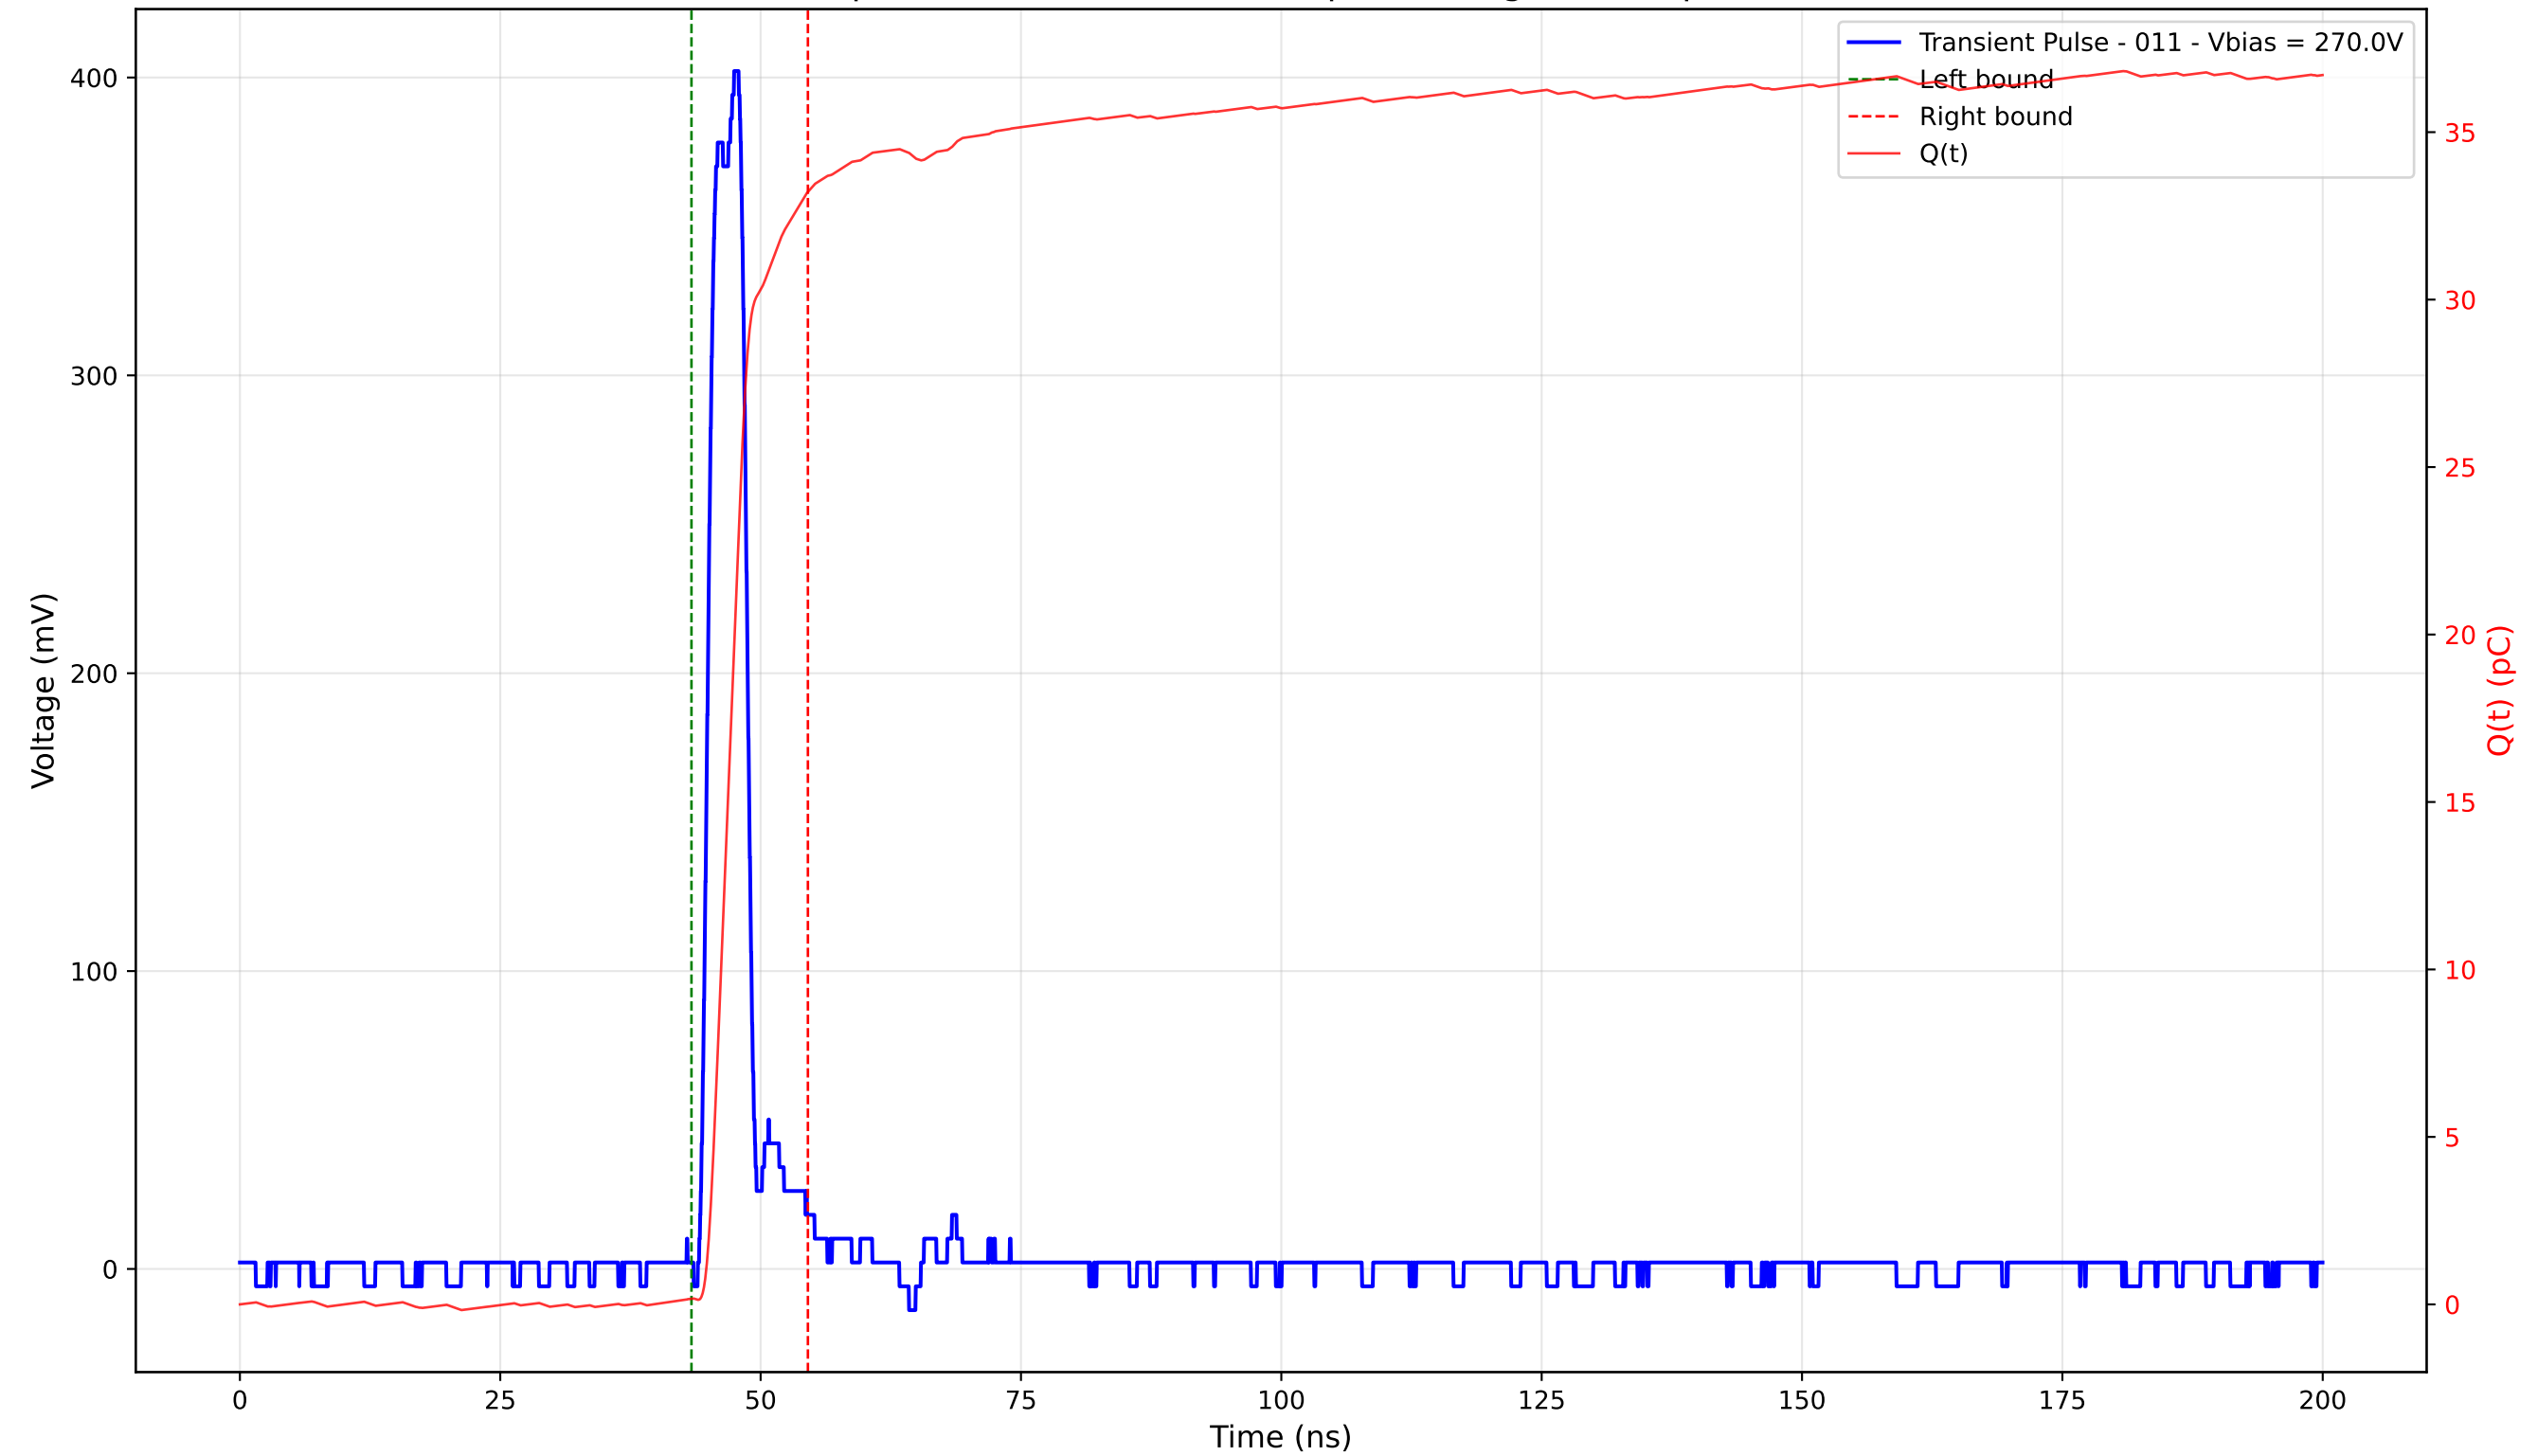


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 32.72 pC - Rise Time: 1.42 ns

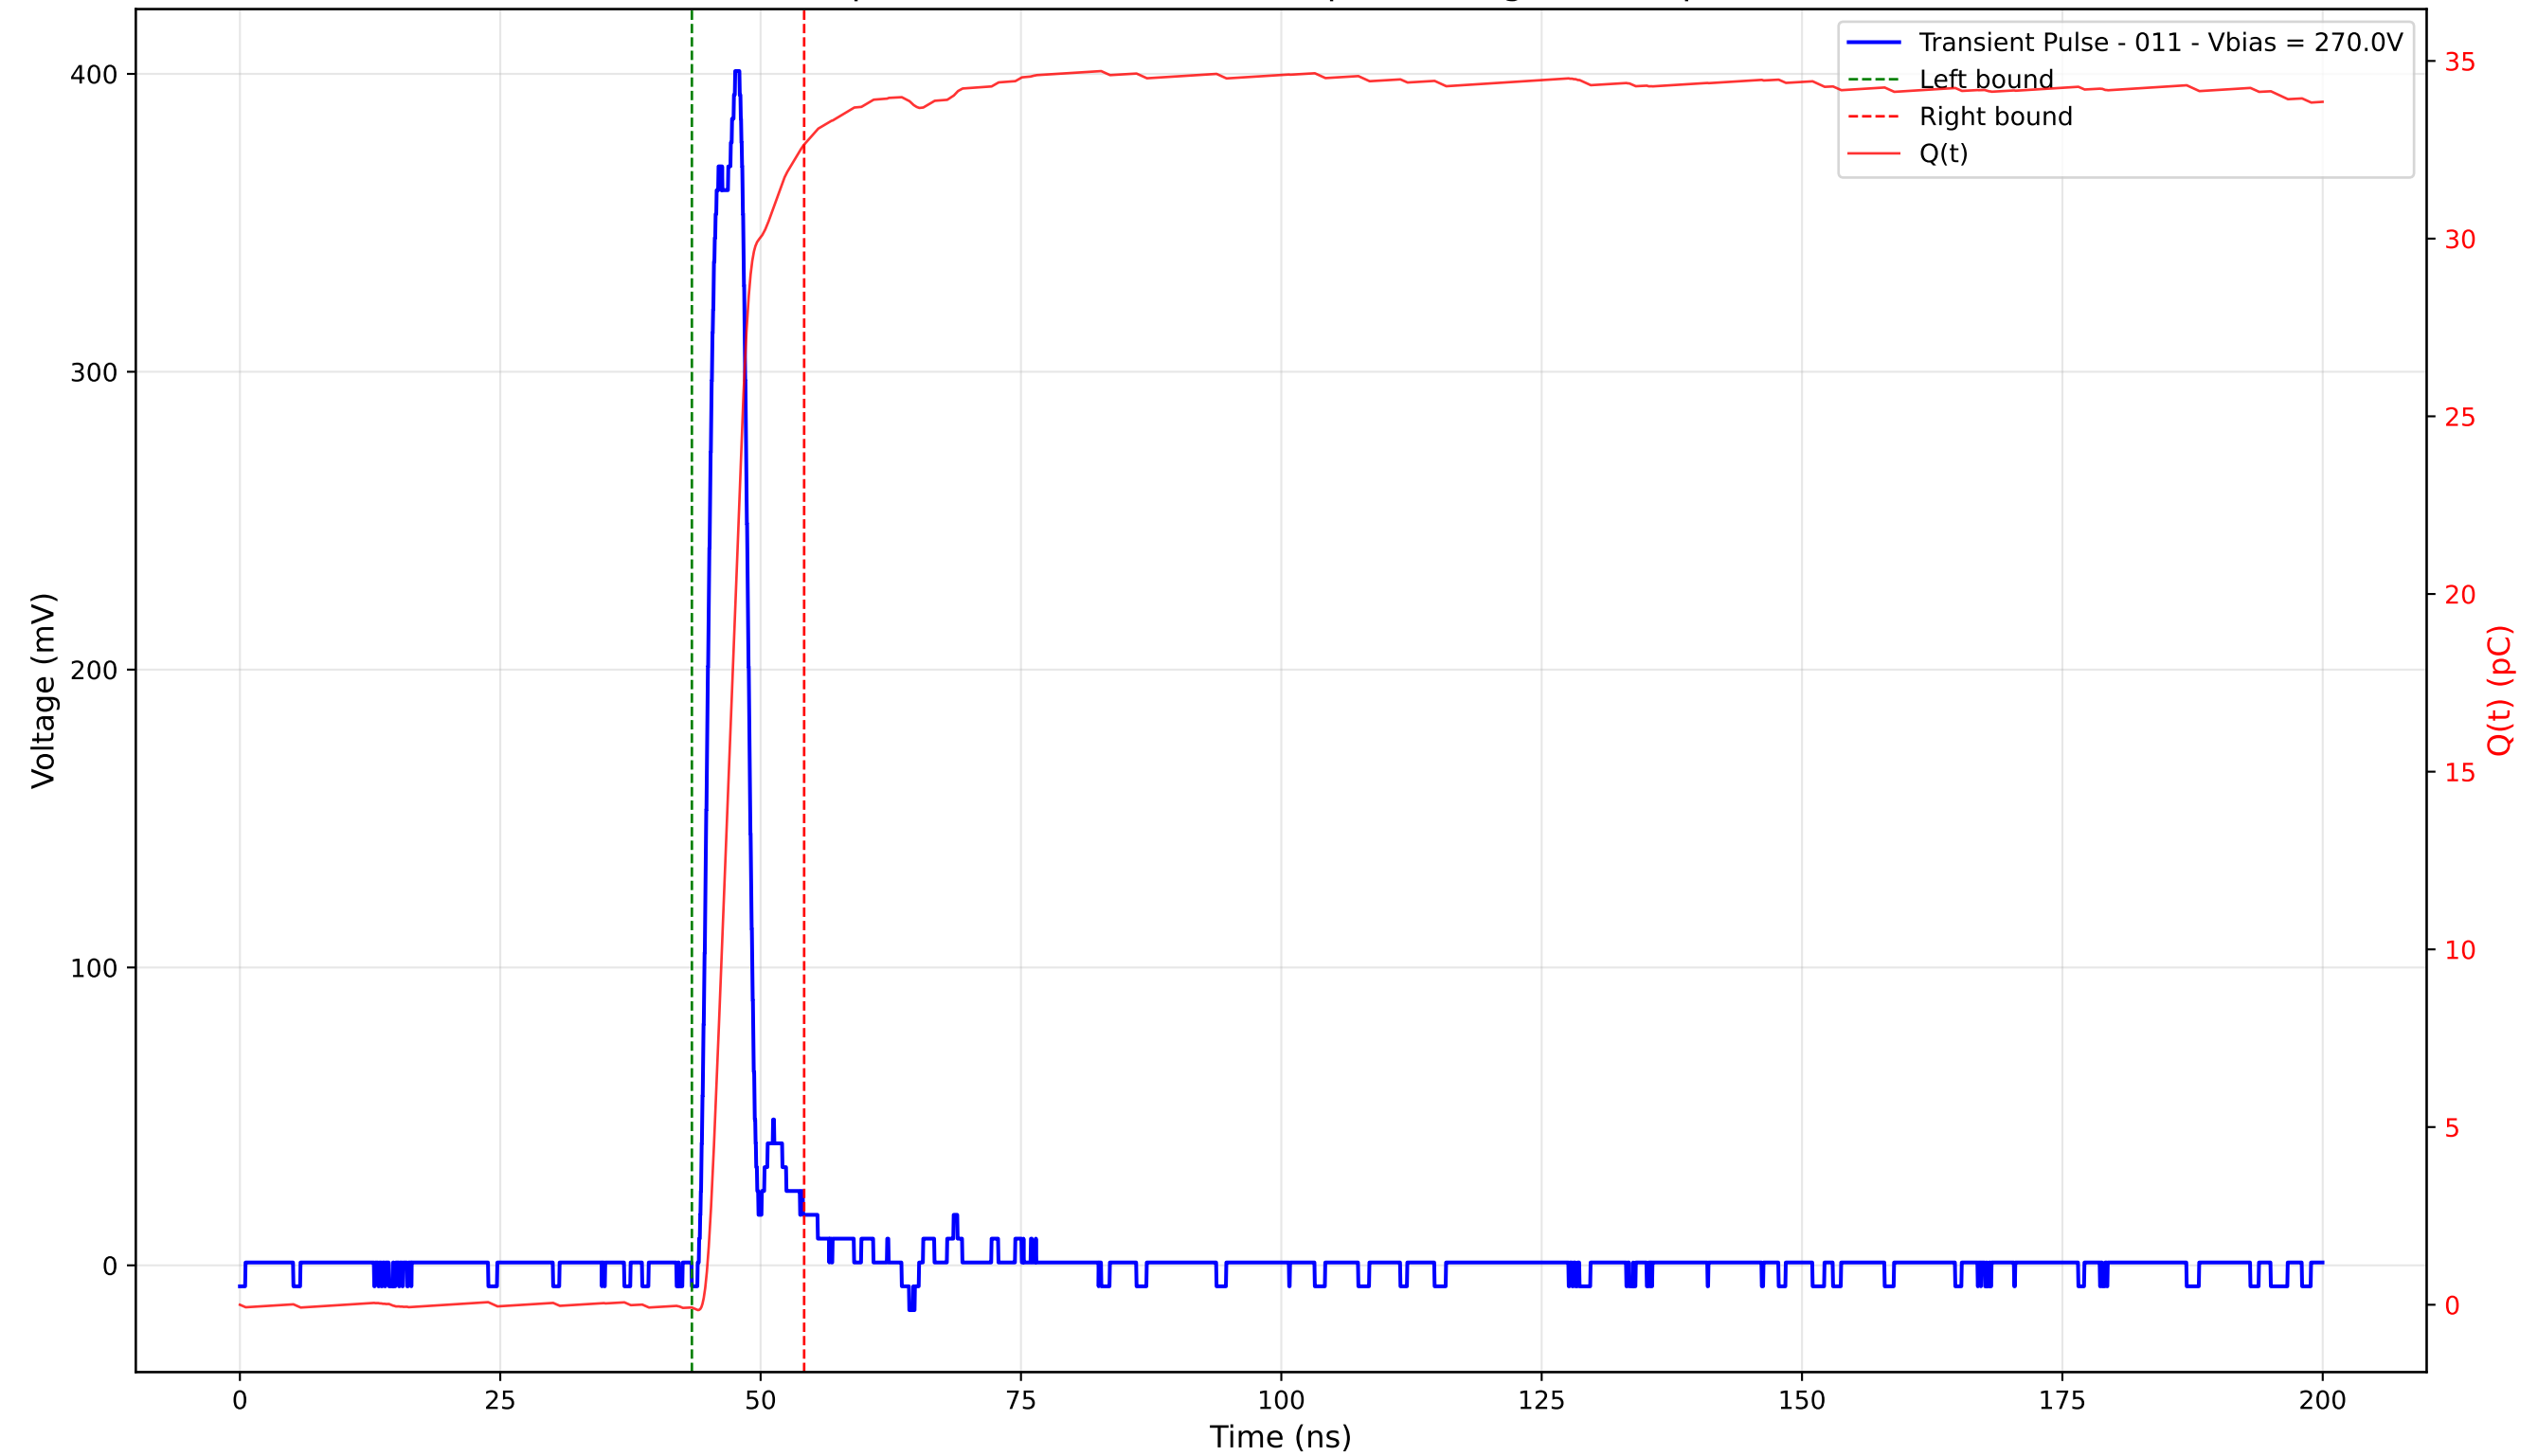


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 32.43 pC - Rise Time: 2.58 ns

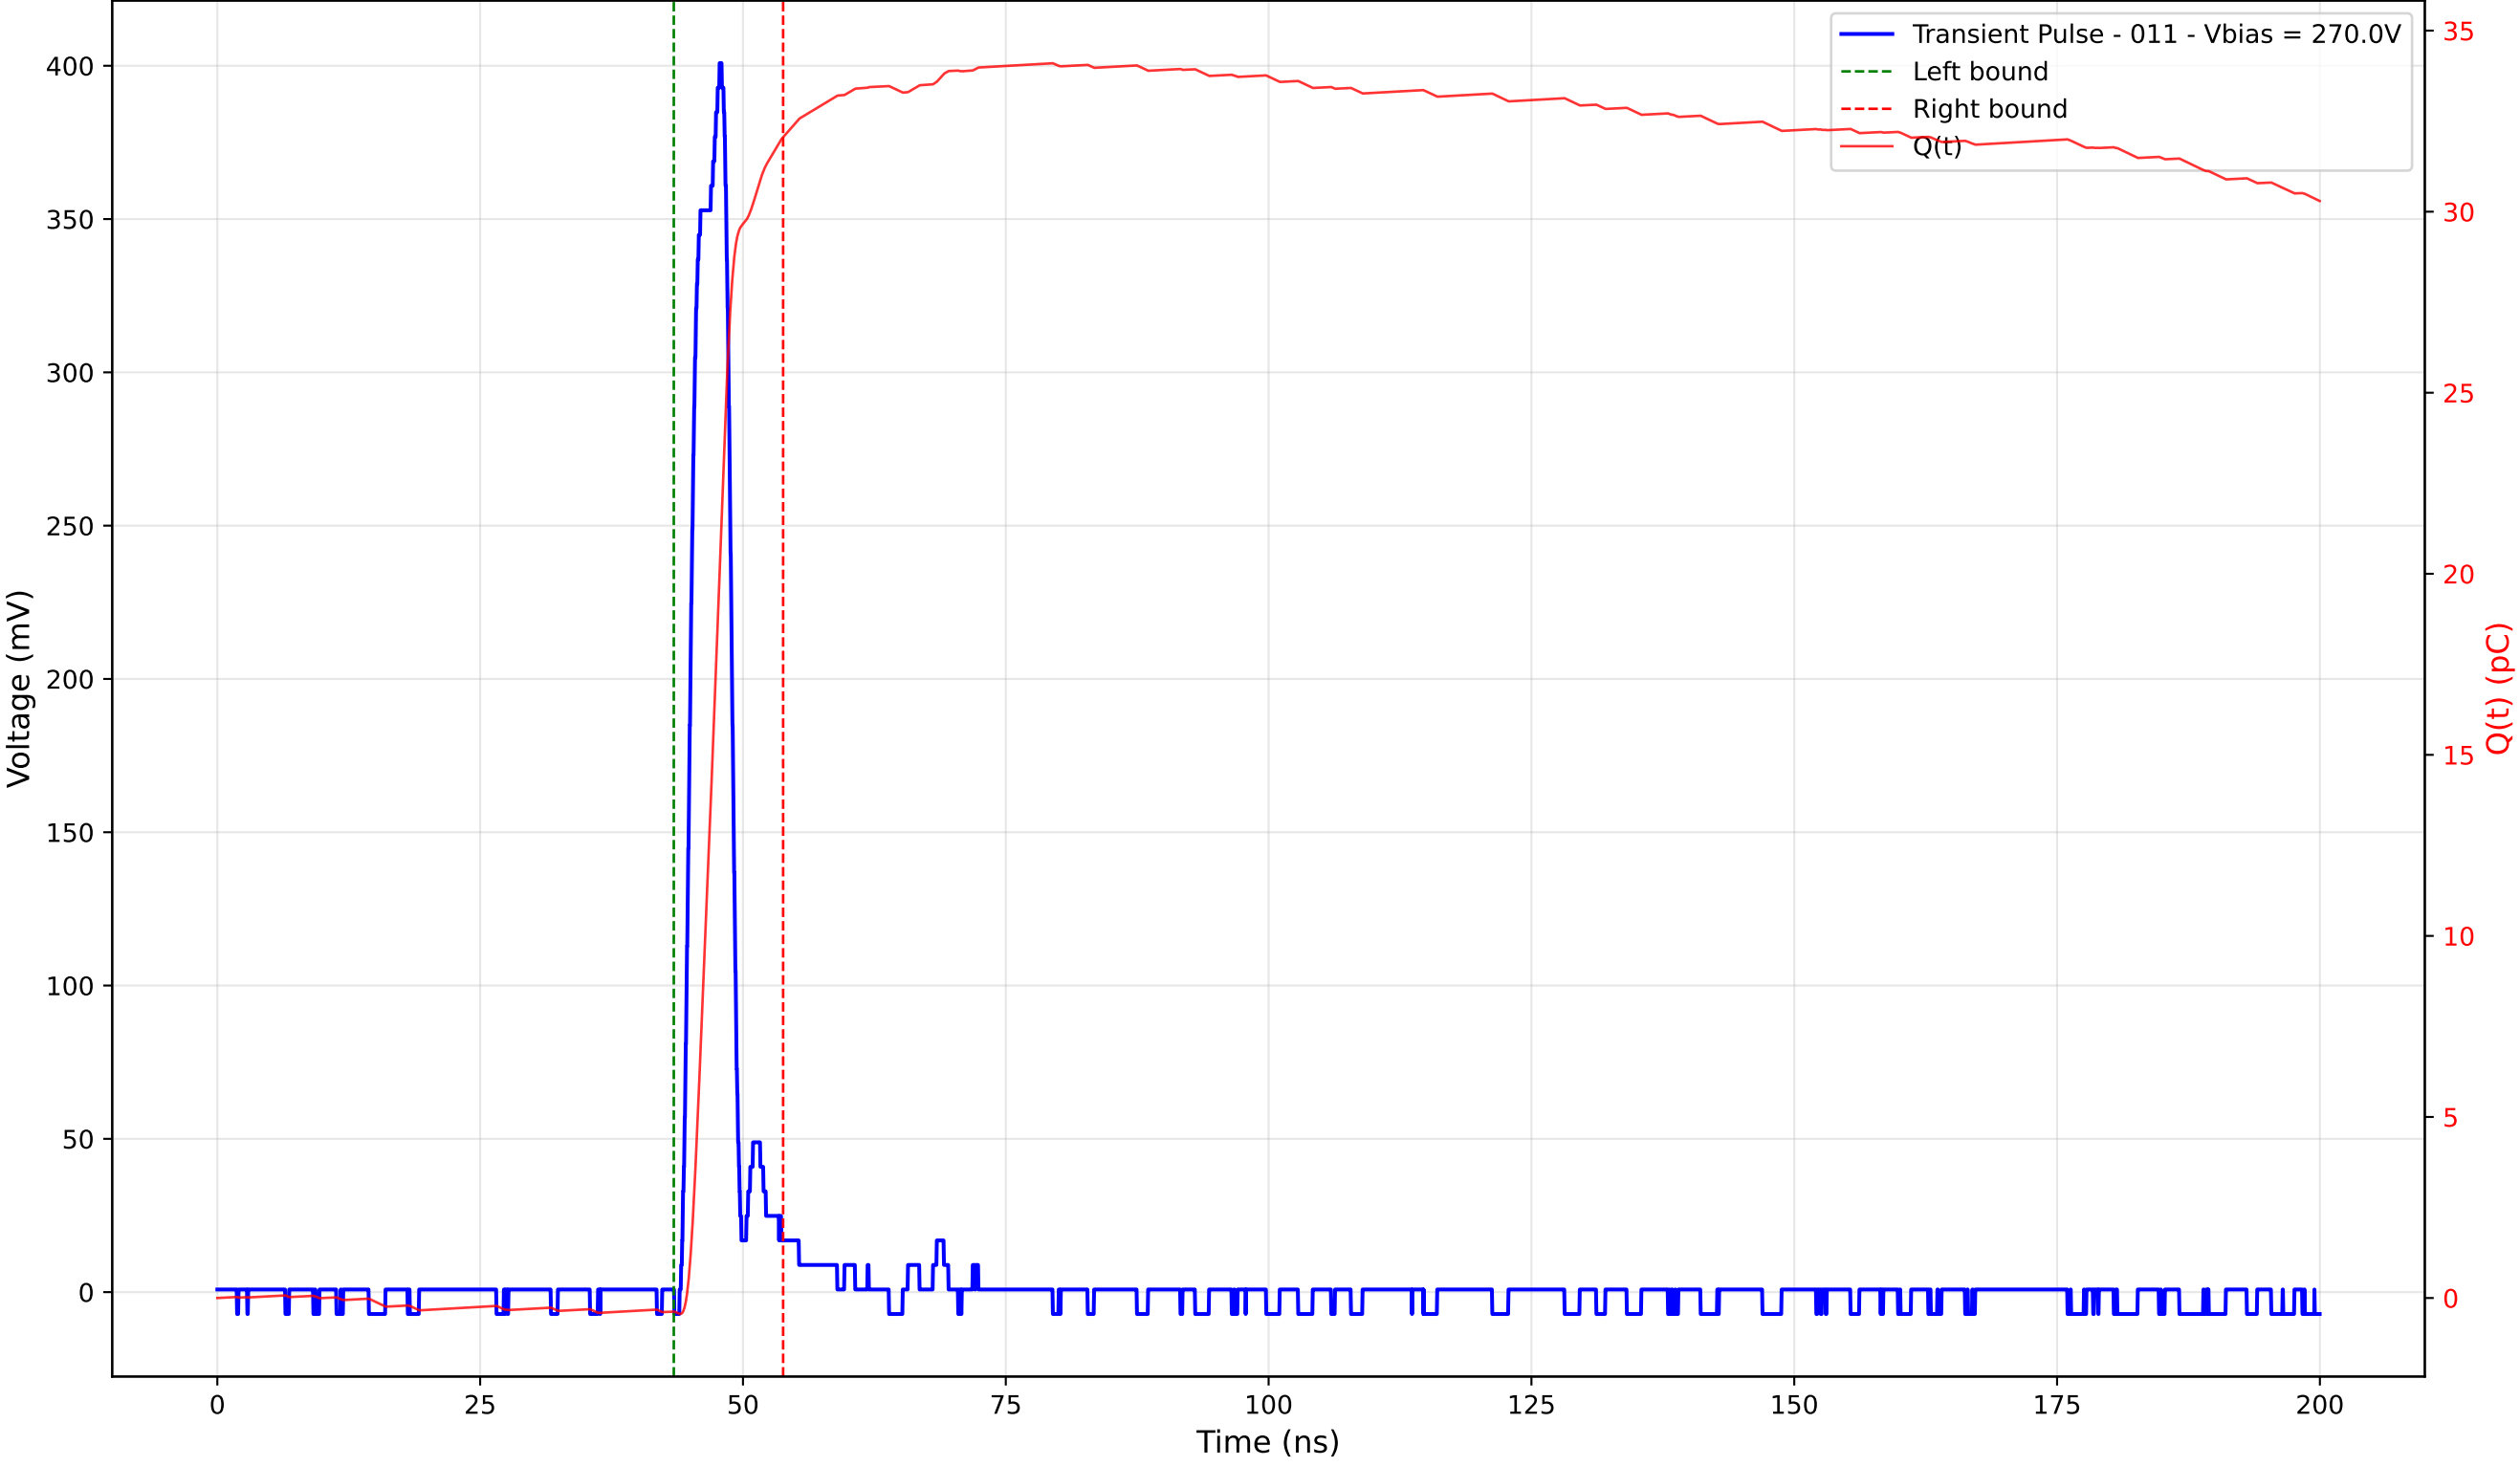


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 33.09 pC - Rise Time: 2.77 ns

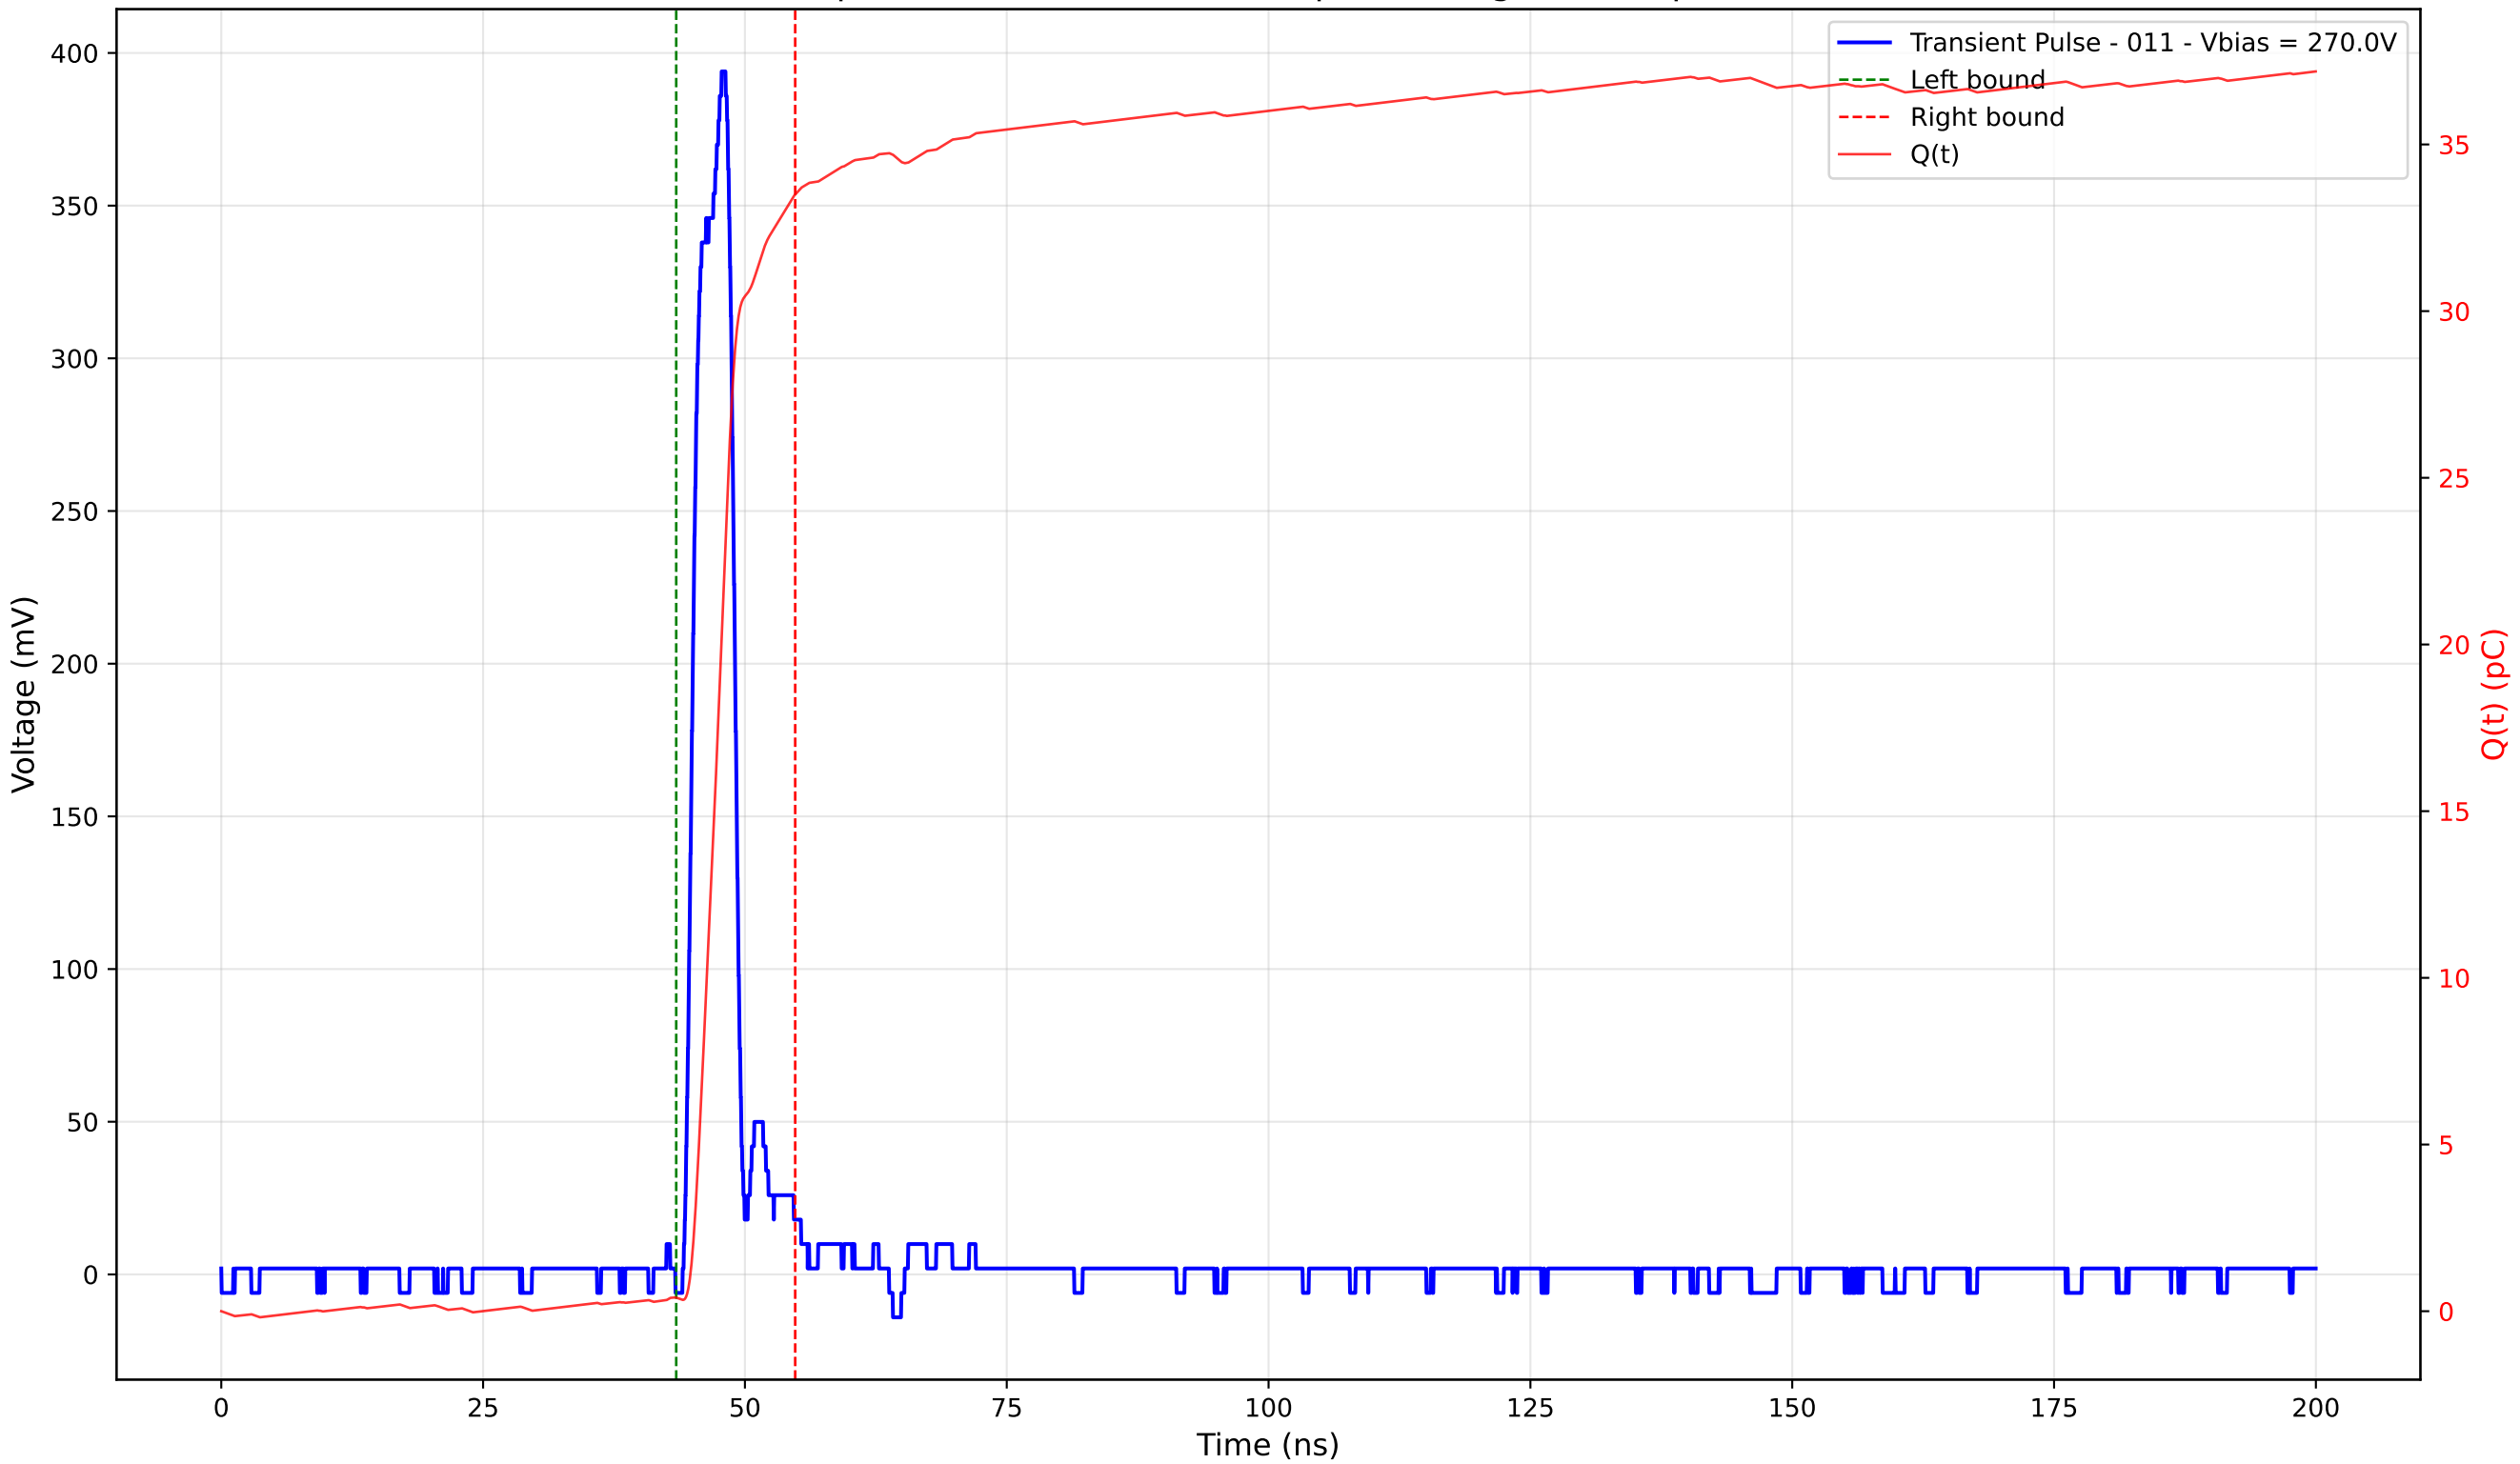


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 31.95 pC - Rise Time: 3.02 ns

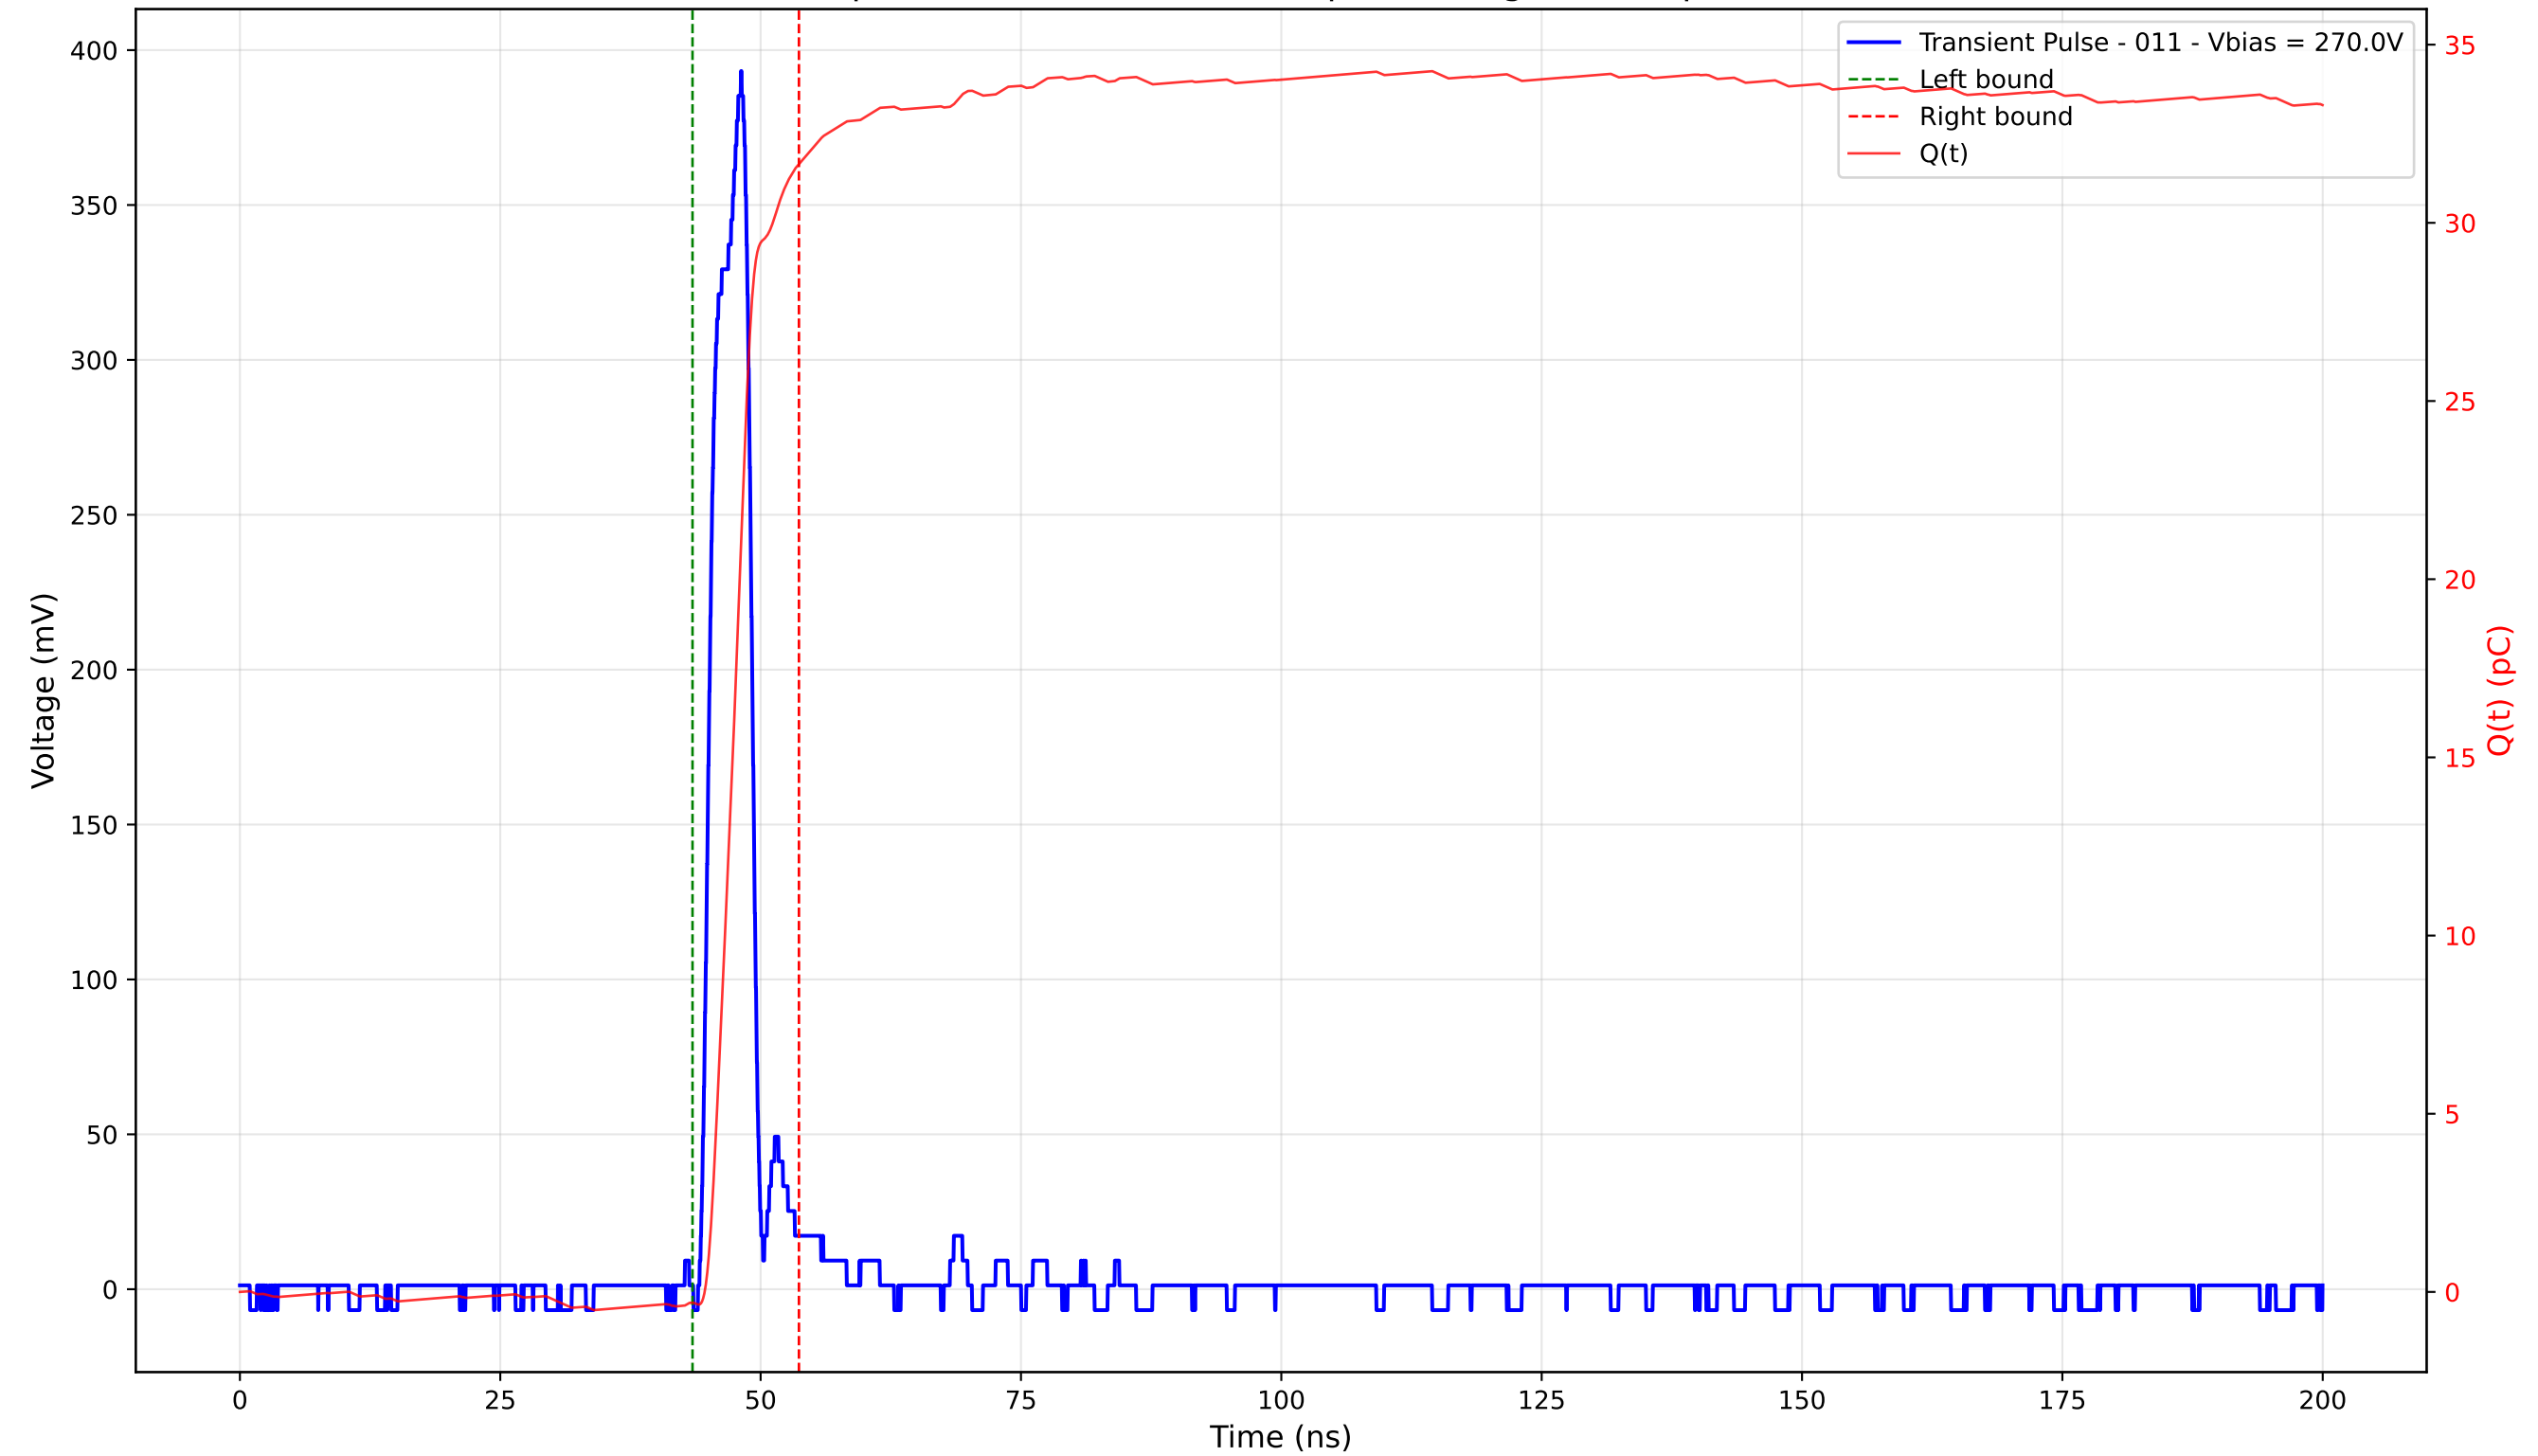


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 32.50 pC - Rise Time: 2.99 ns

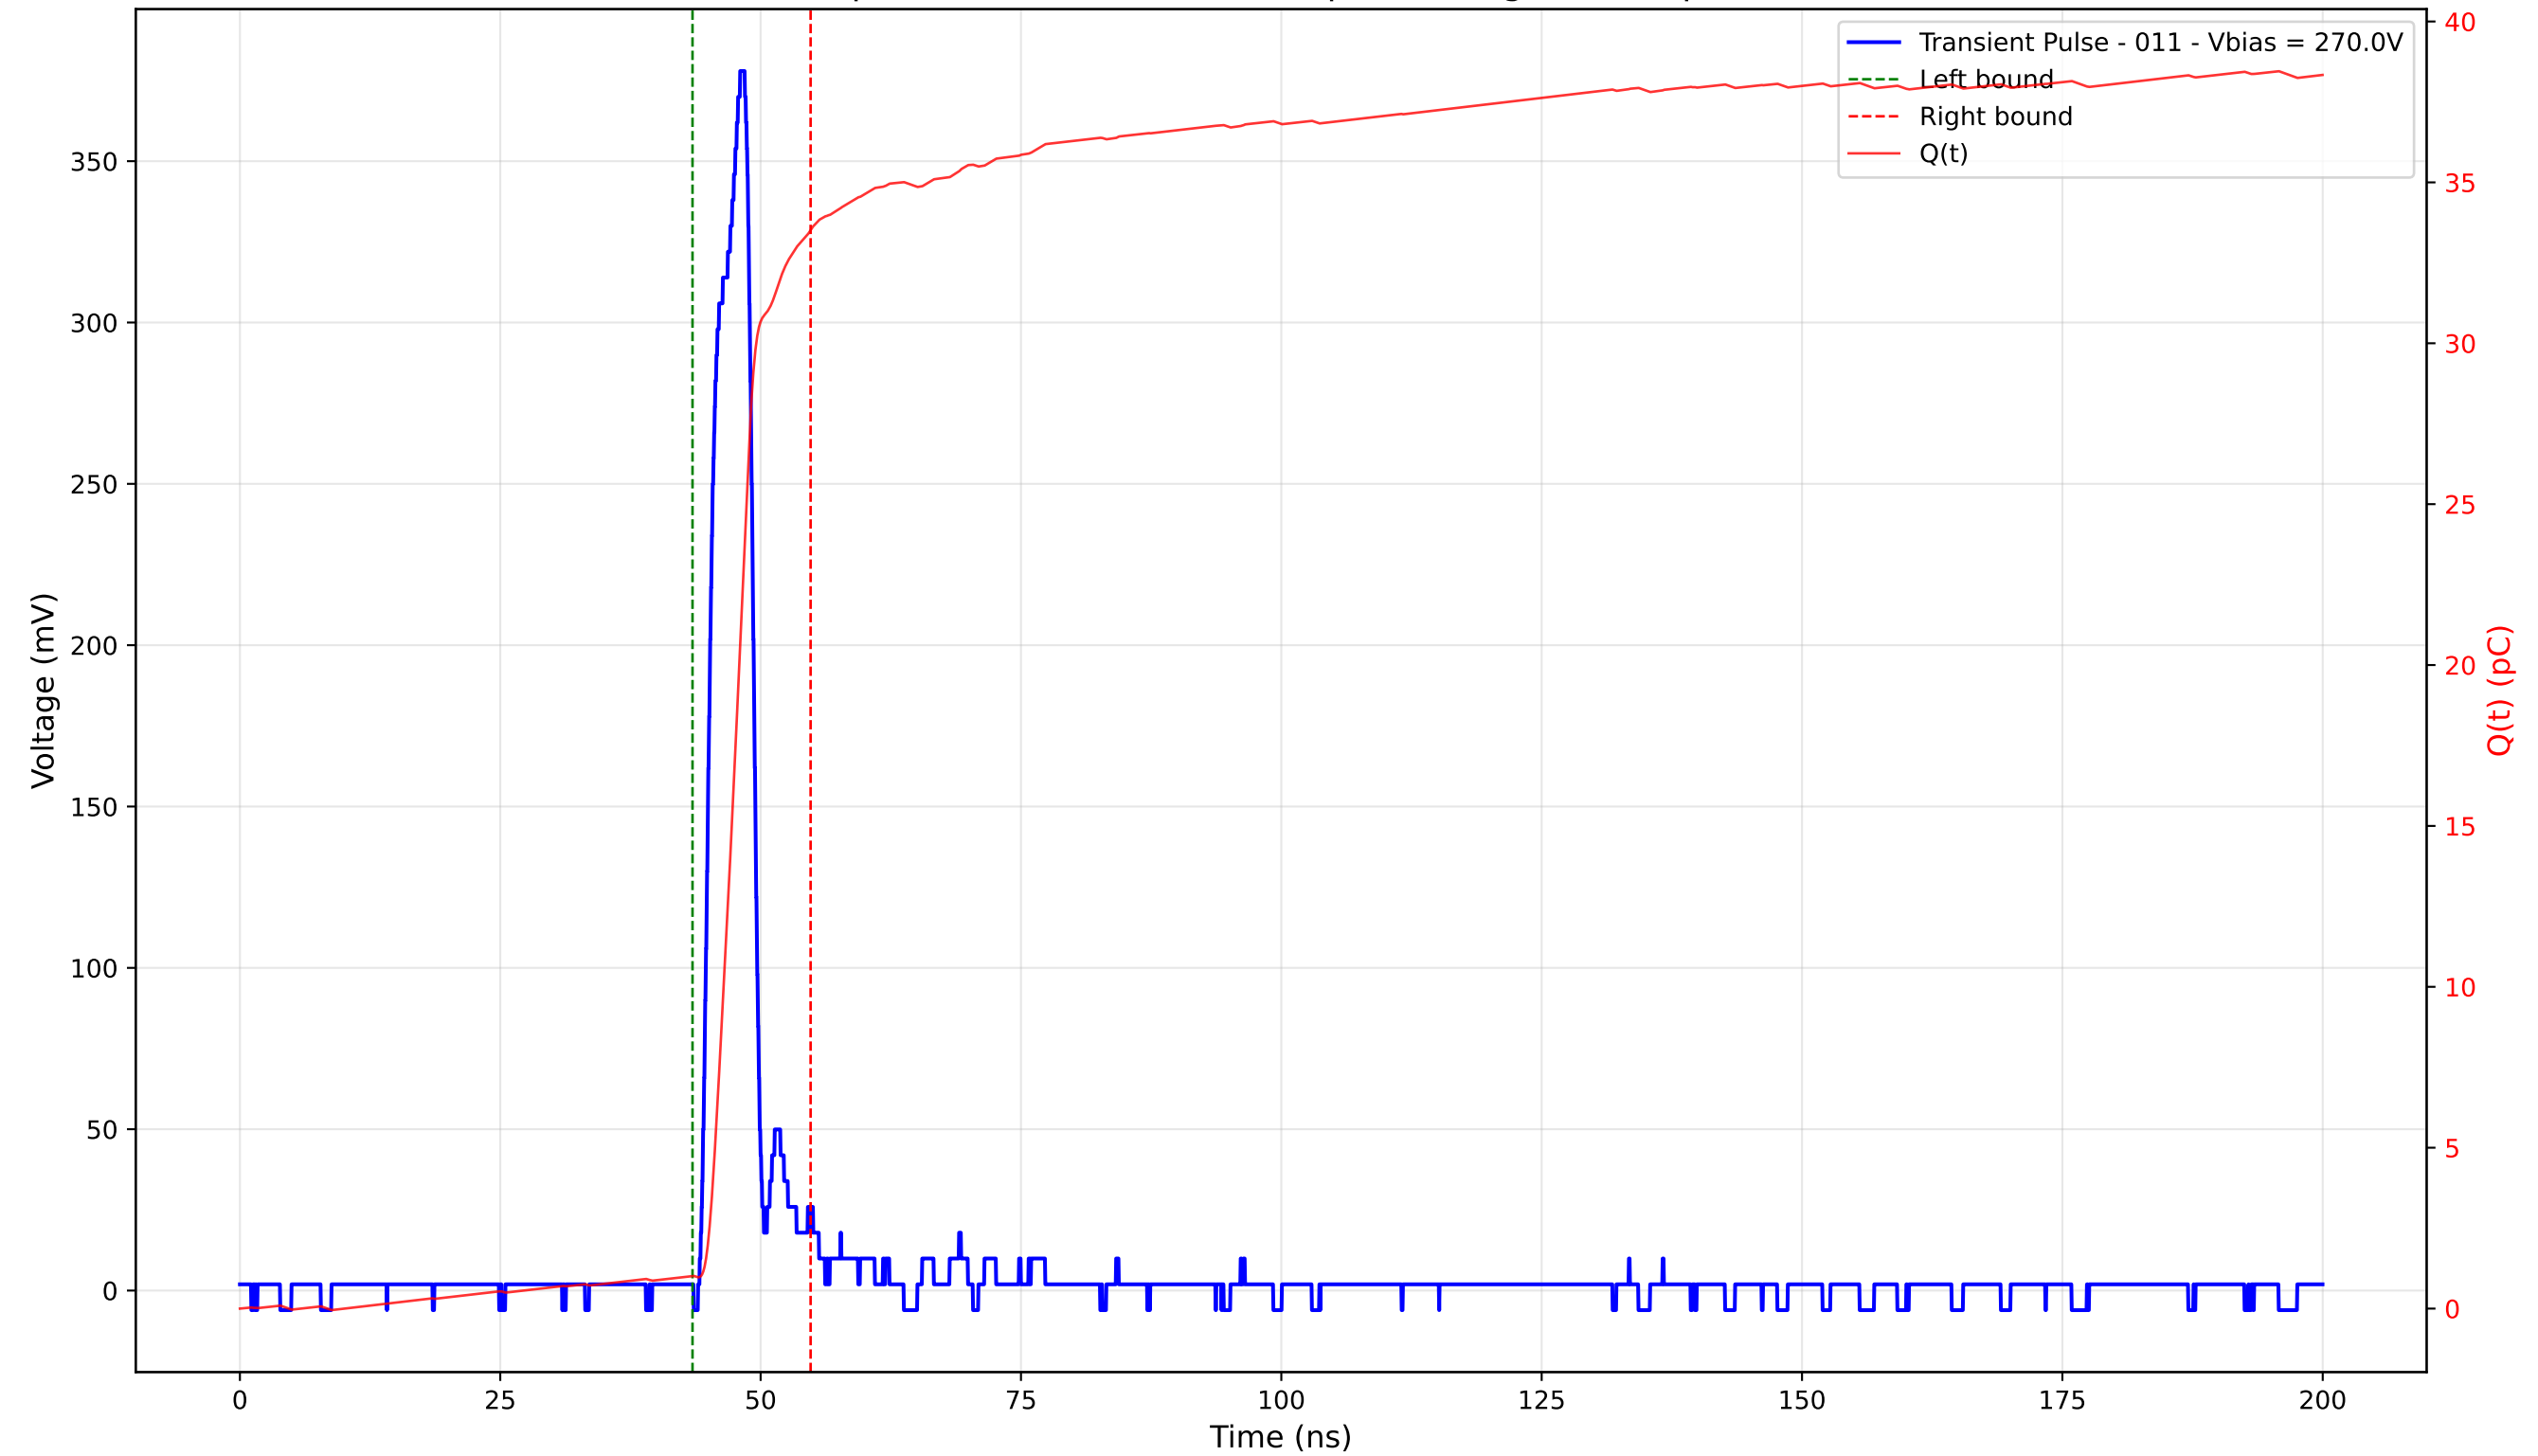


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 31.50 pC - Rise Time: 3.15 ns

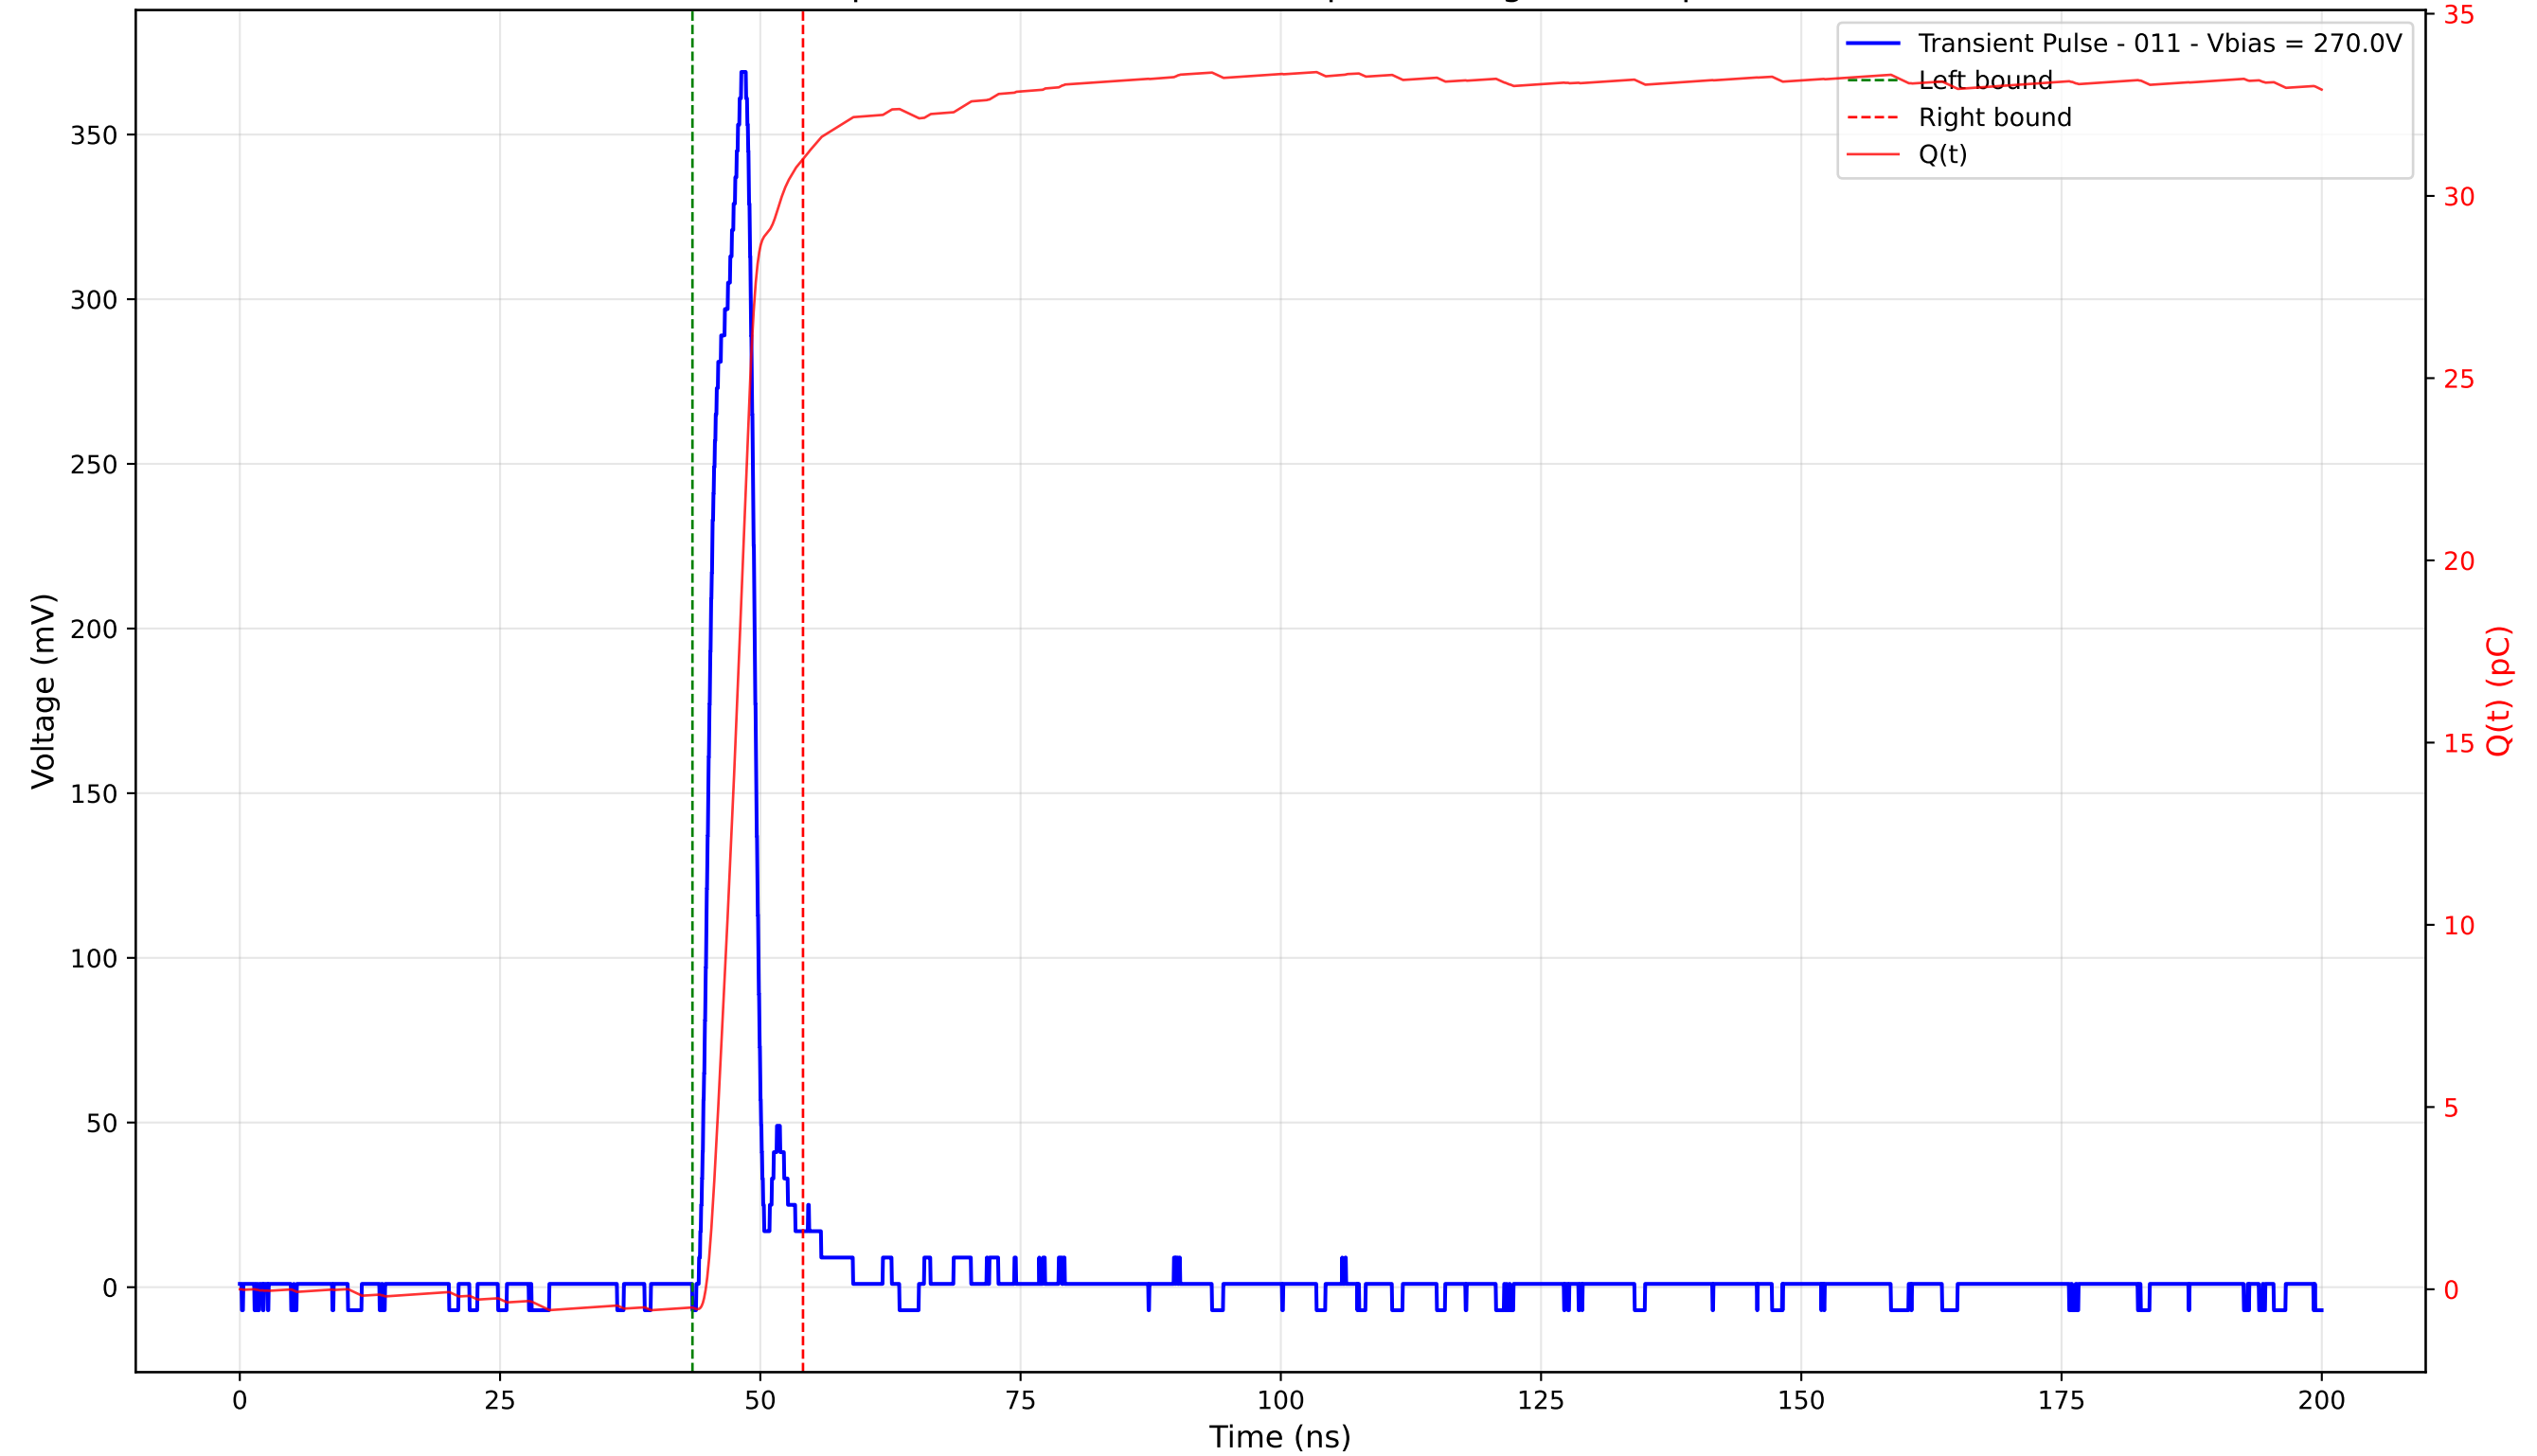


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 32.33 pC - Rise Time: 3.24 ns

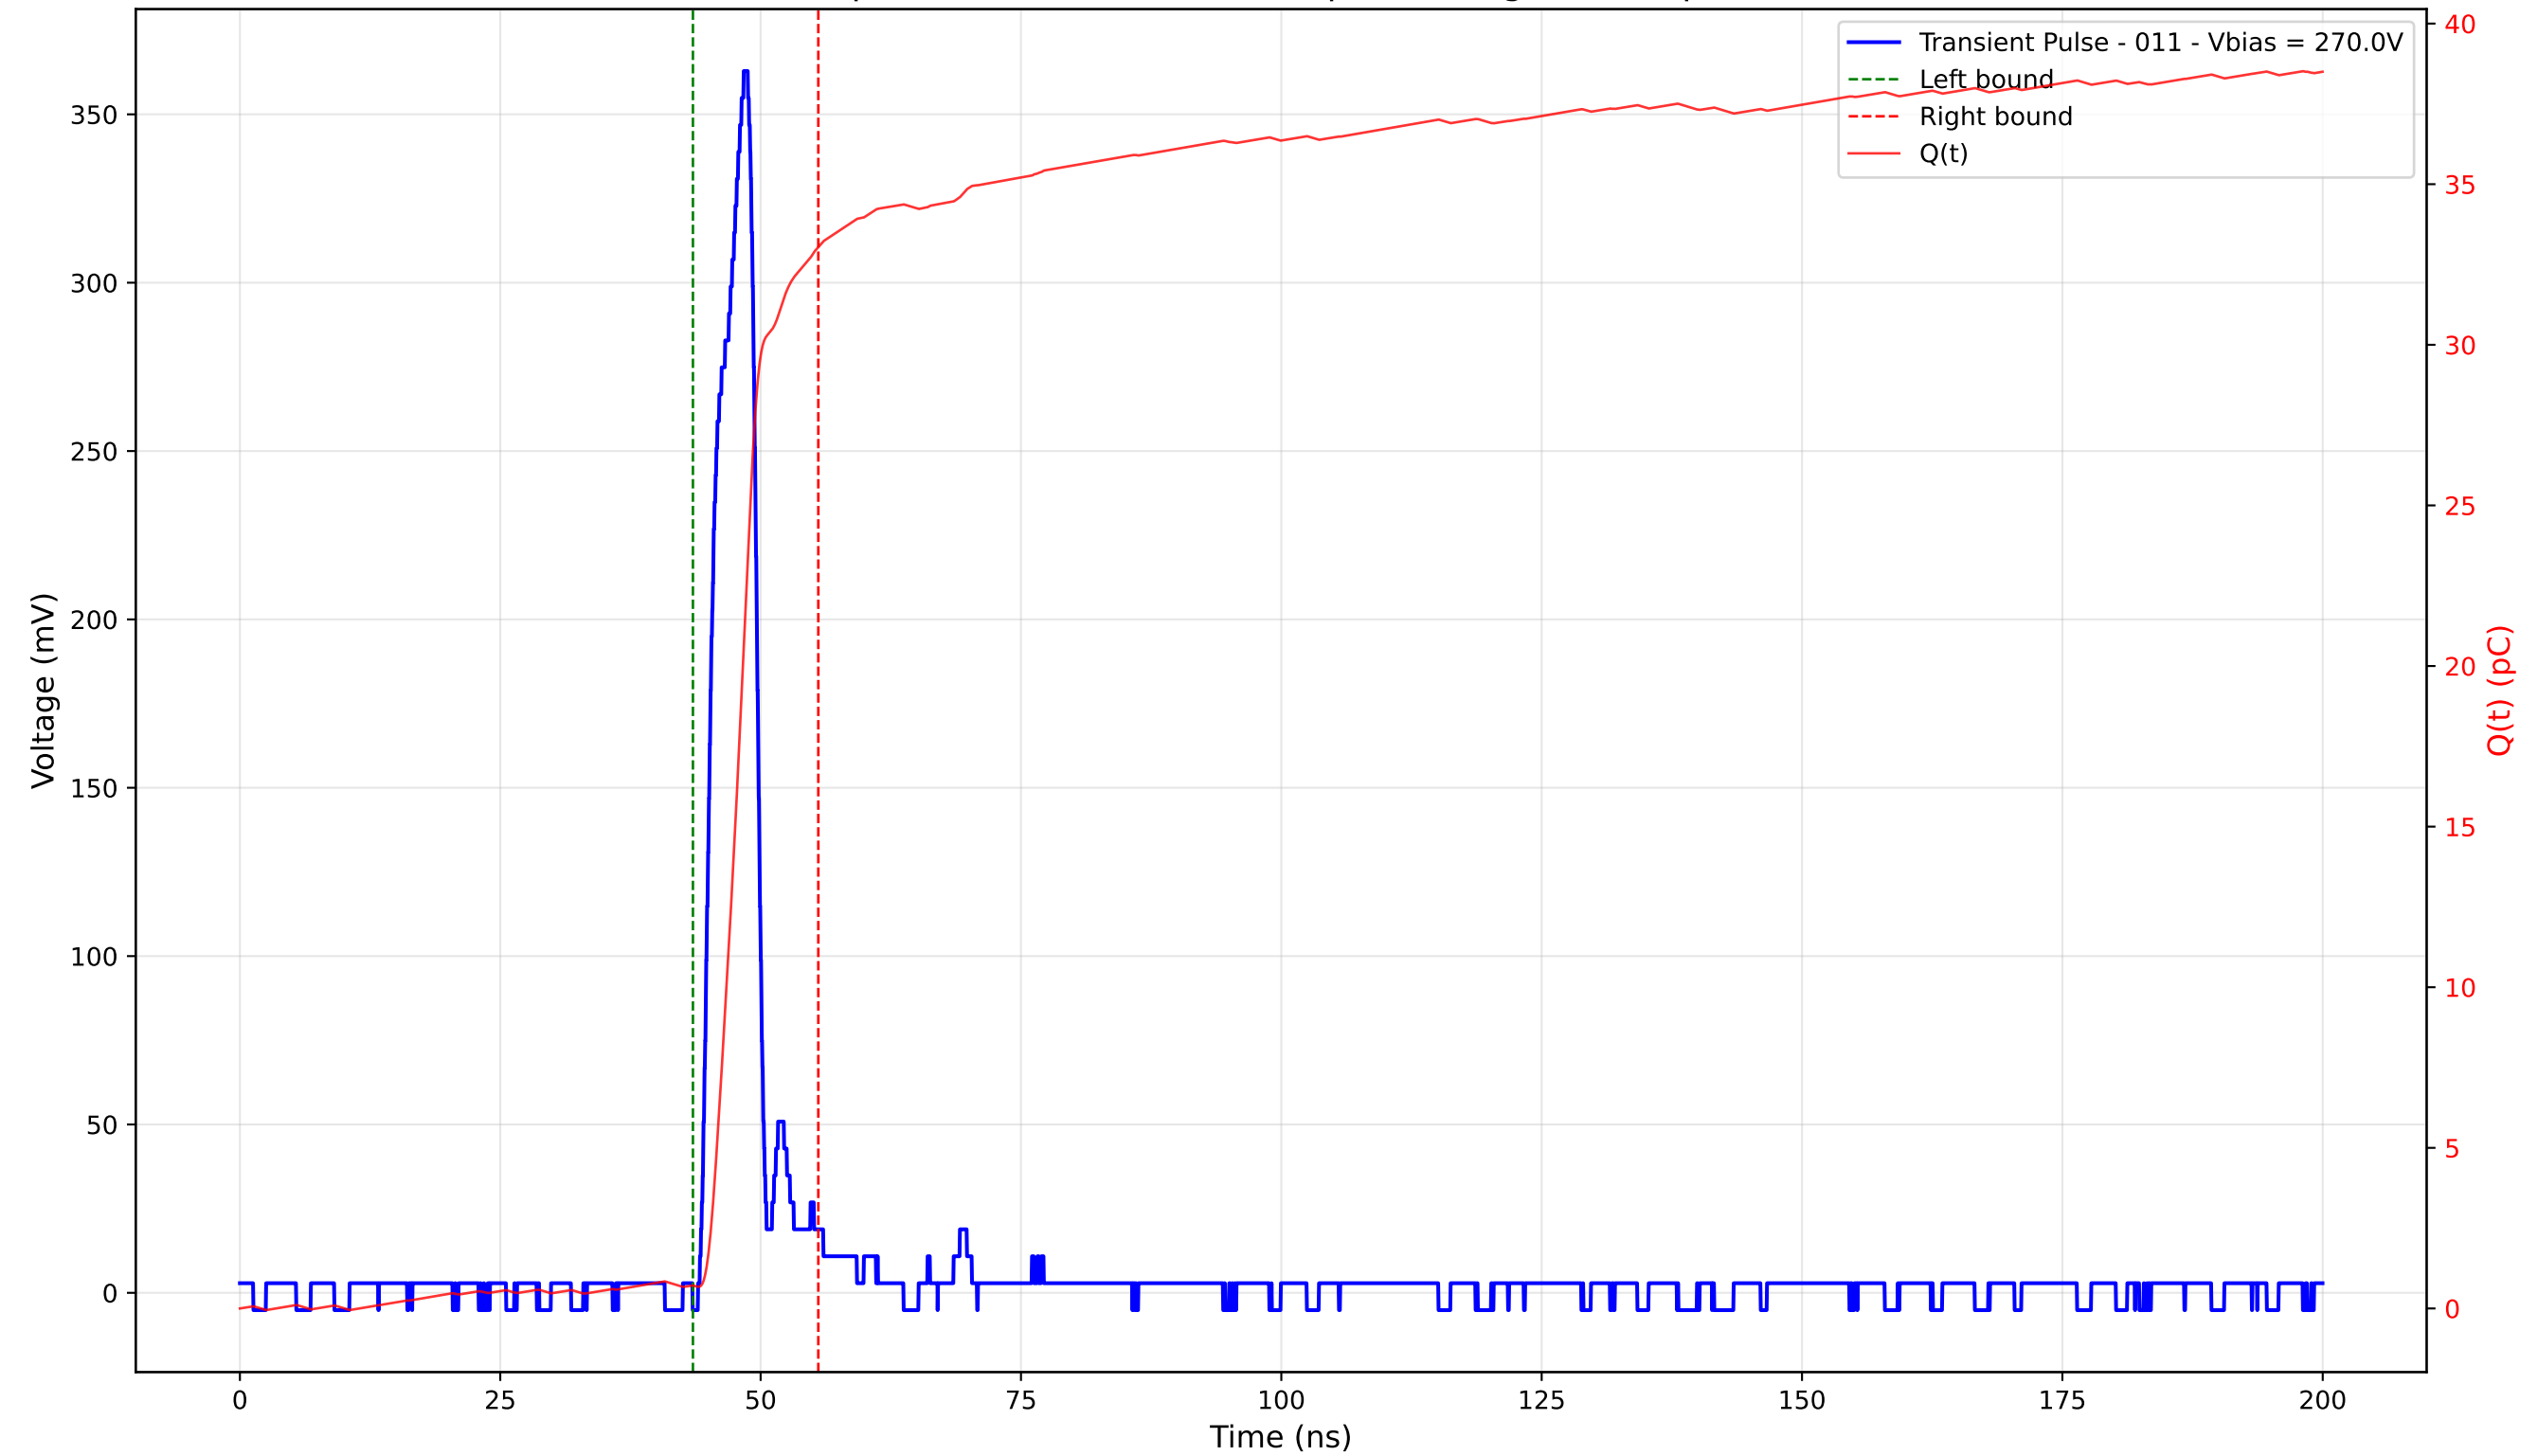


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 31.58 pC - Rise Time: 3.32 ns

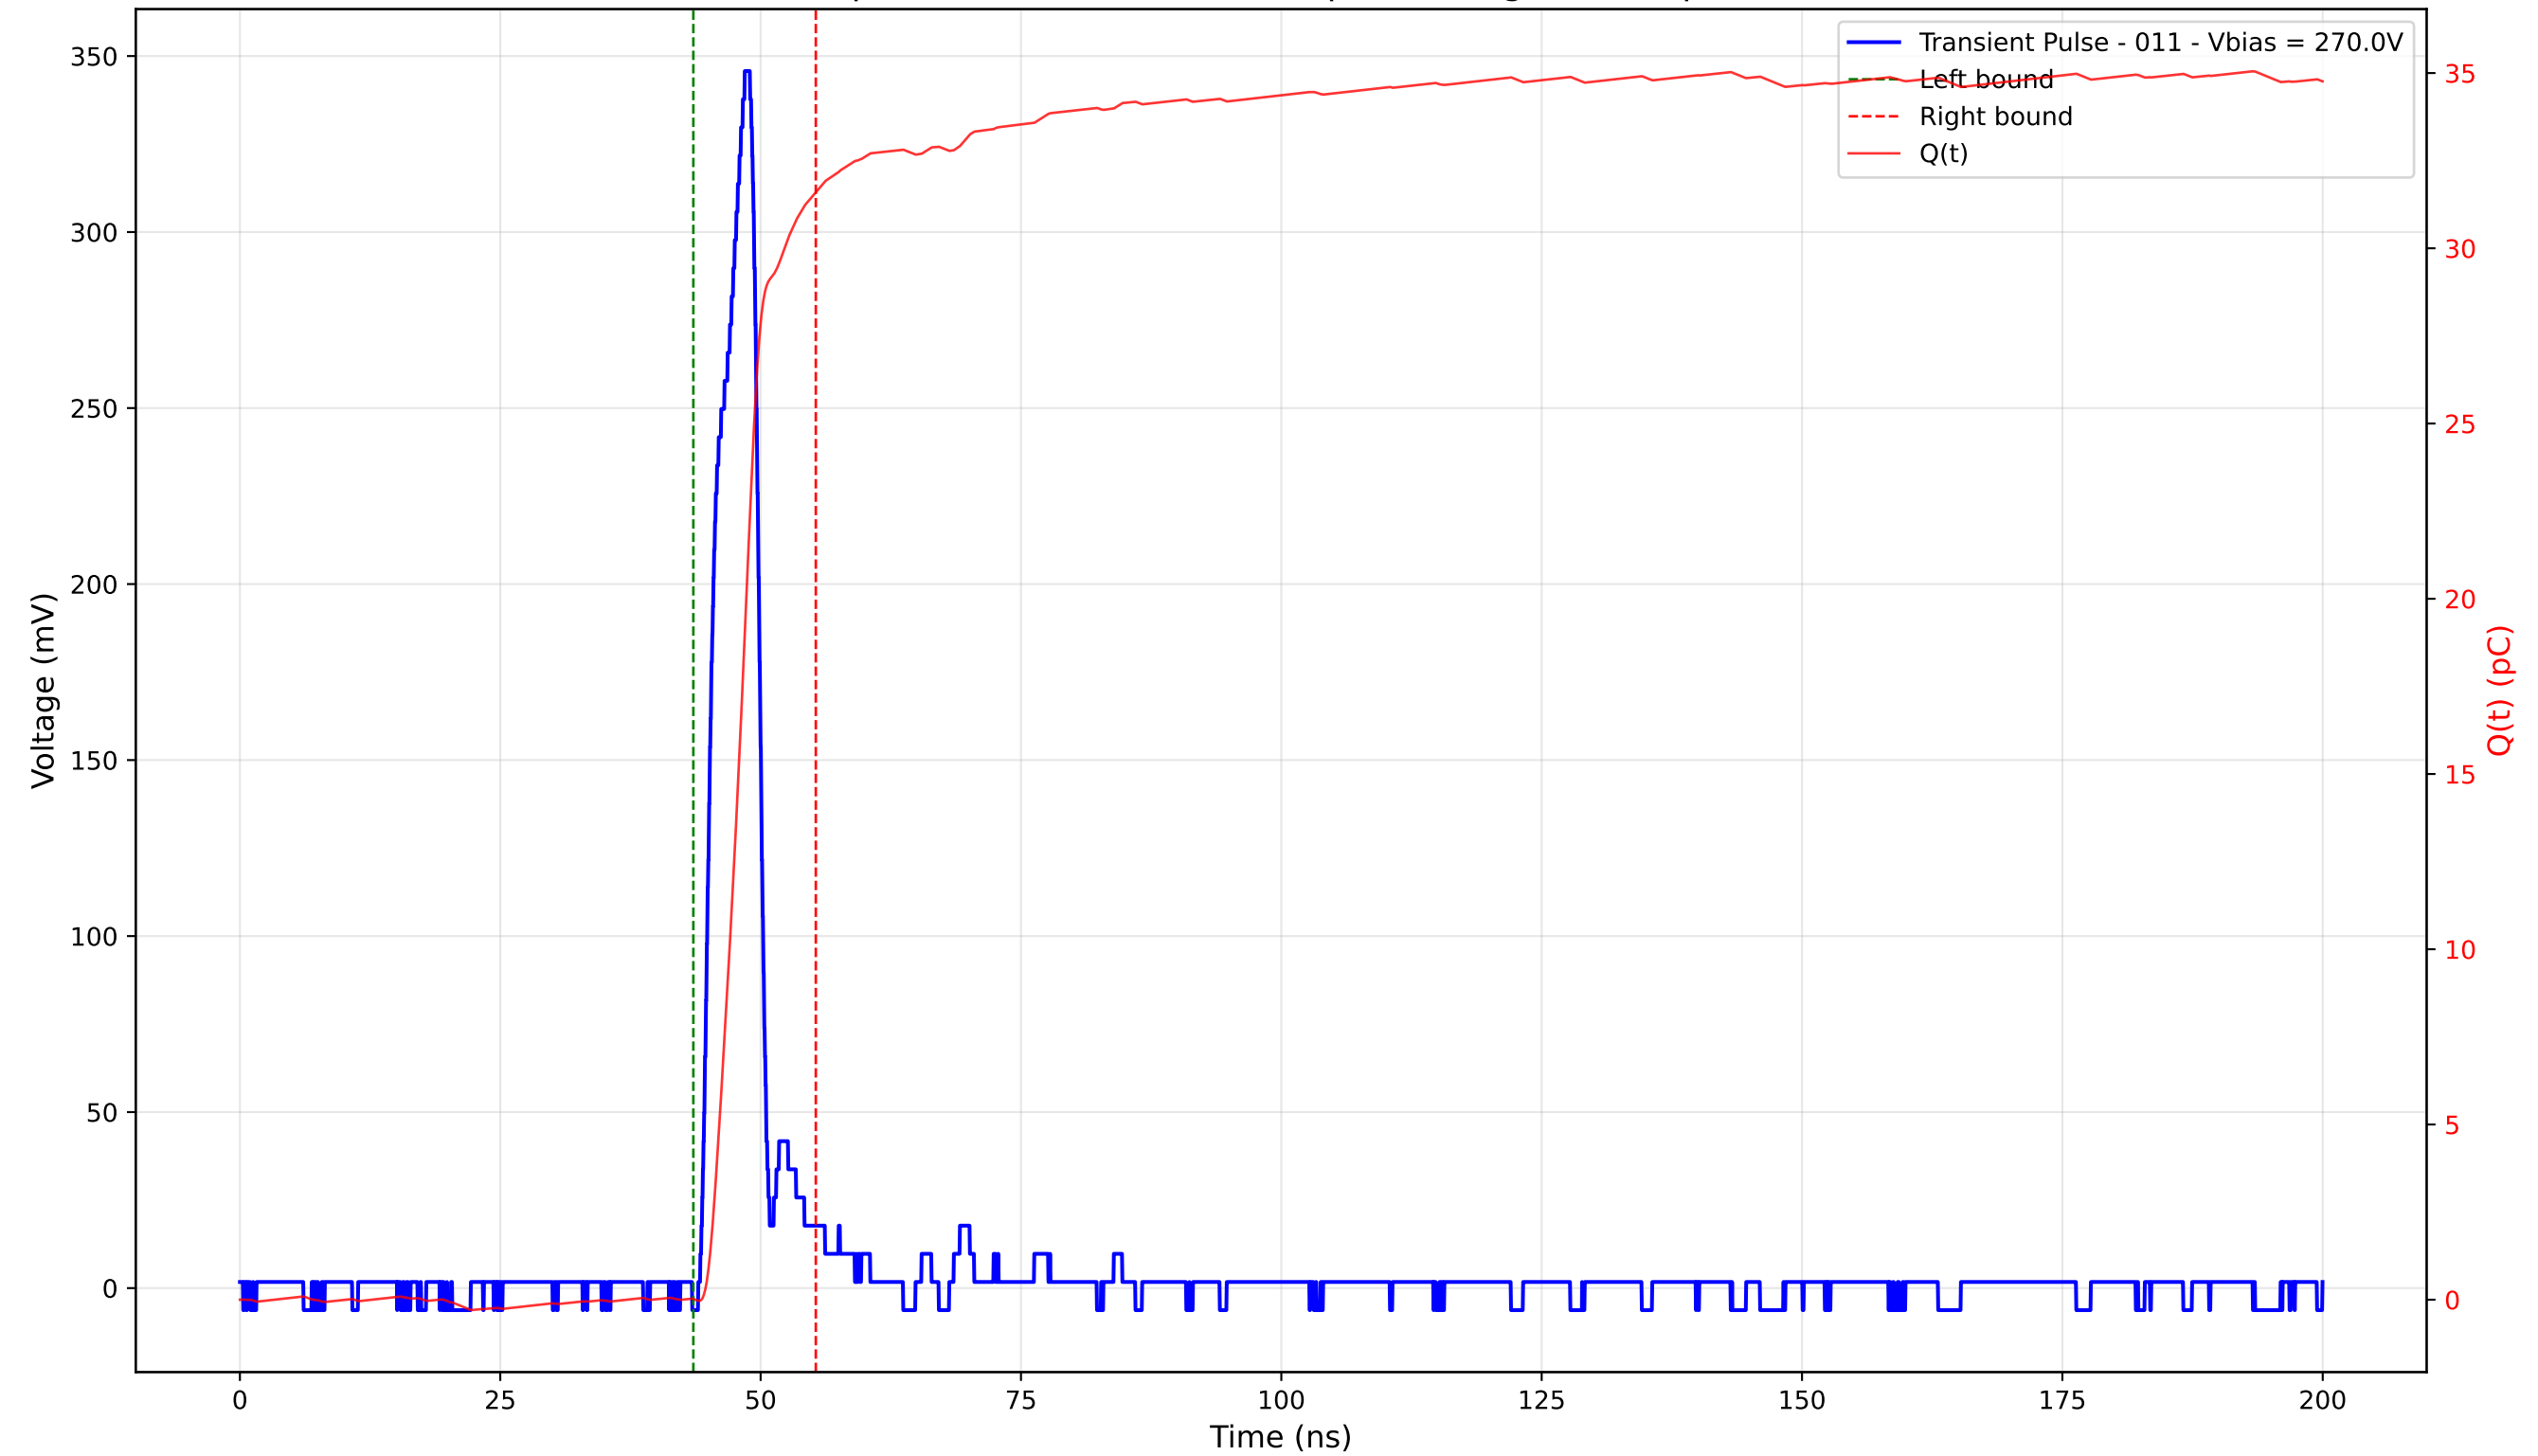


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 31.24 pC - Rise Time: 3.44 ns

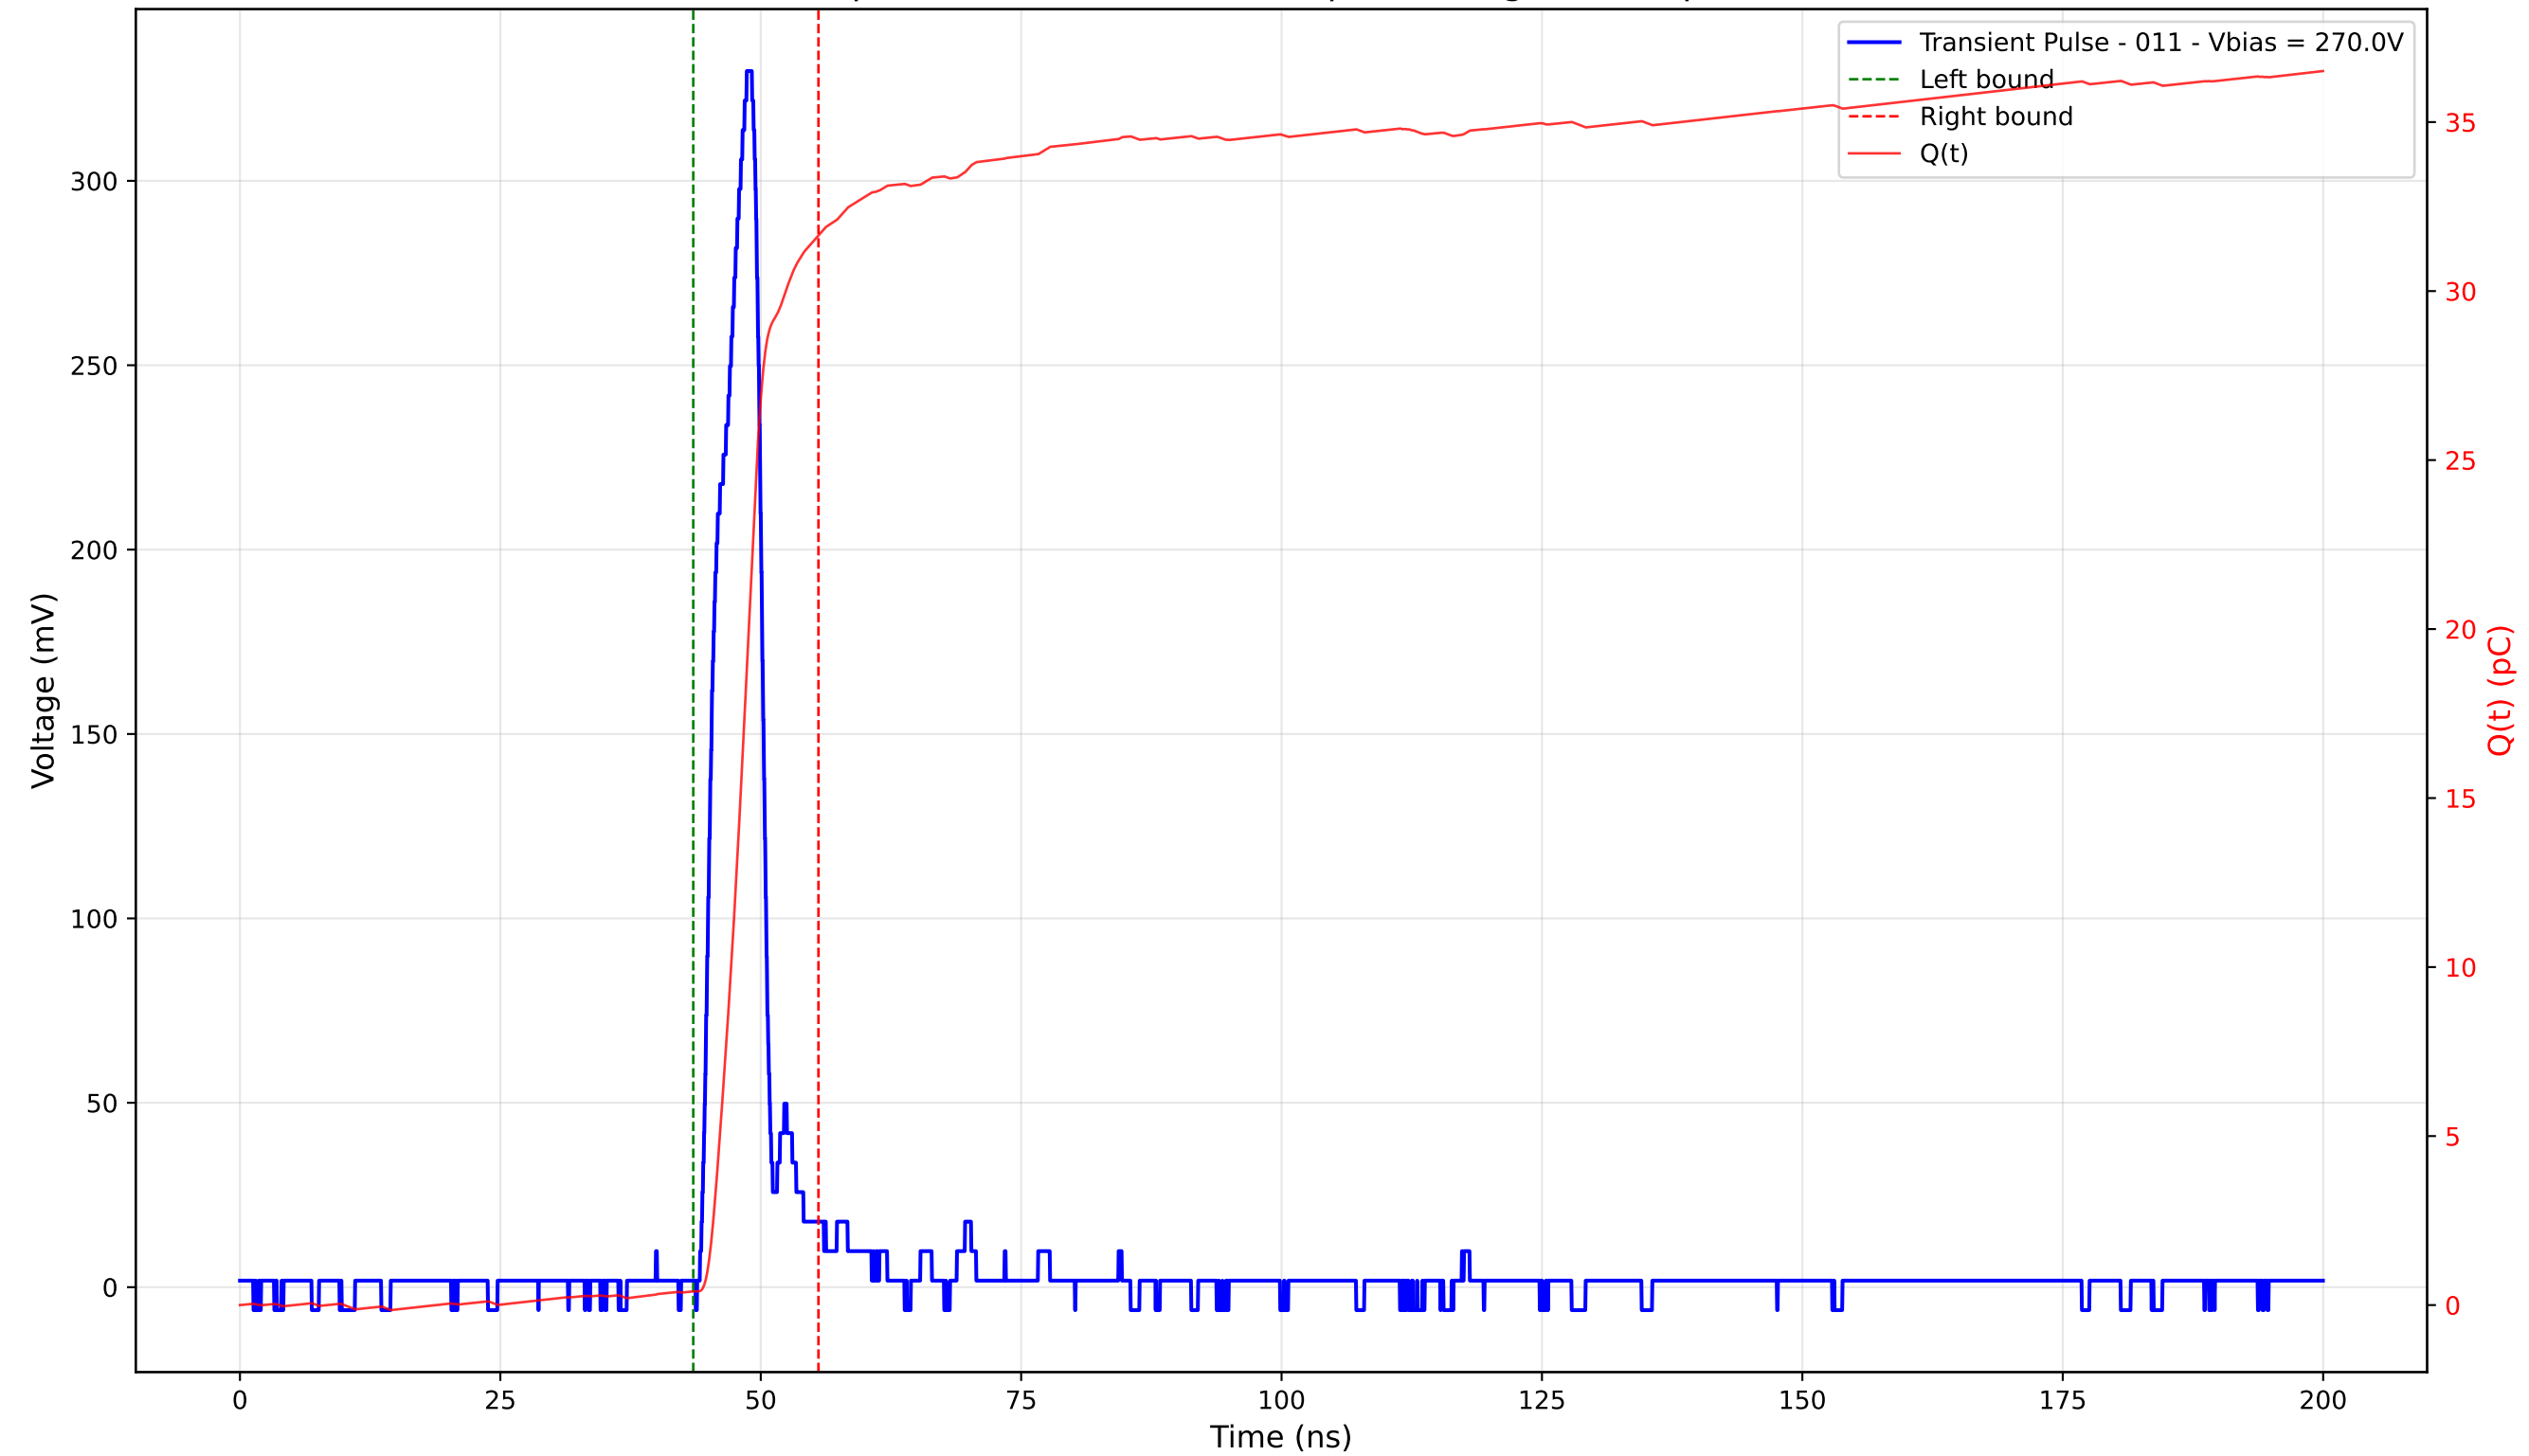


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 30.24 pC - Rise Time: 3.57 ns

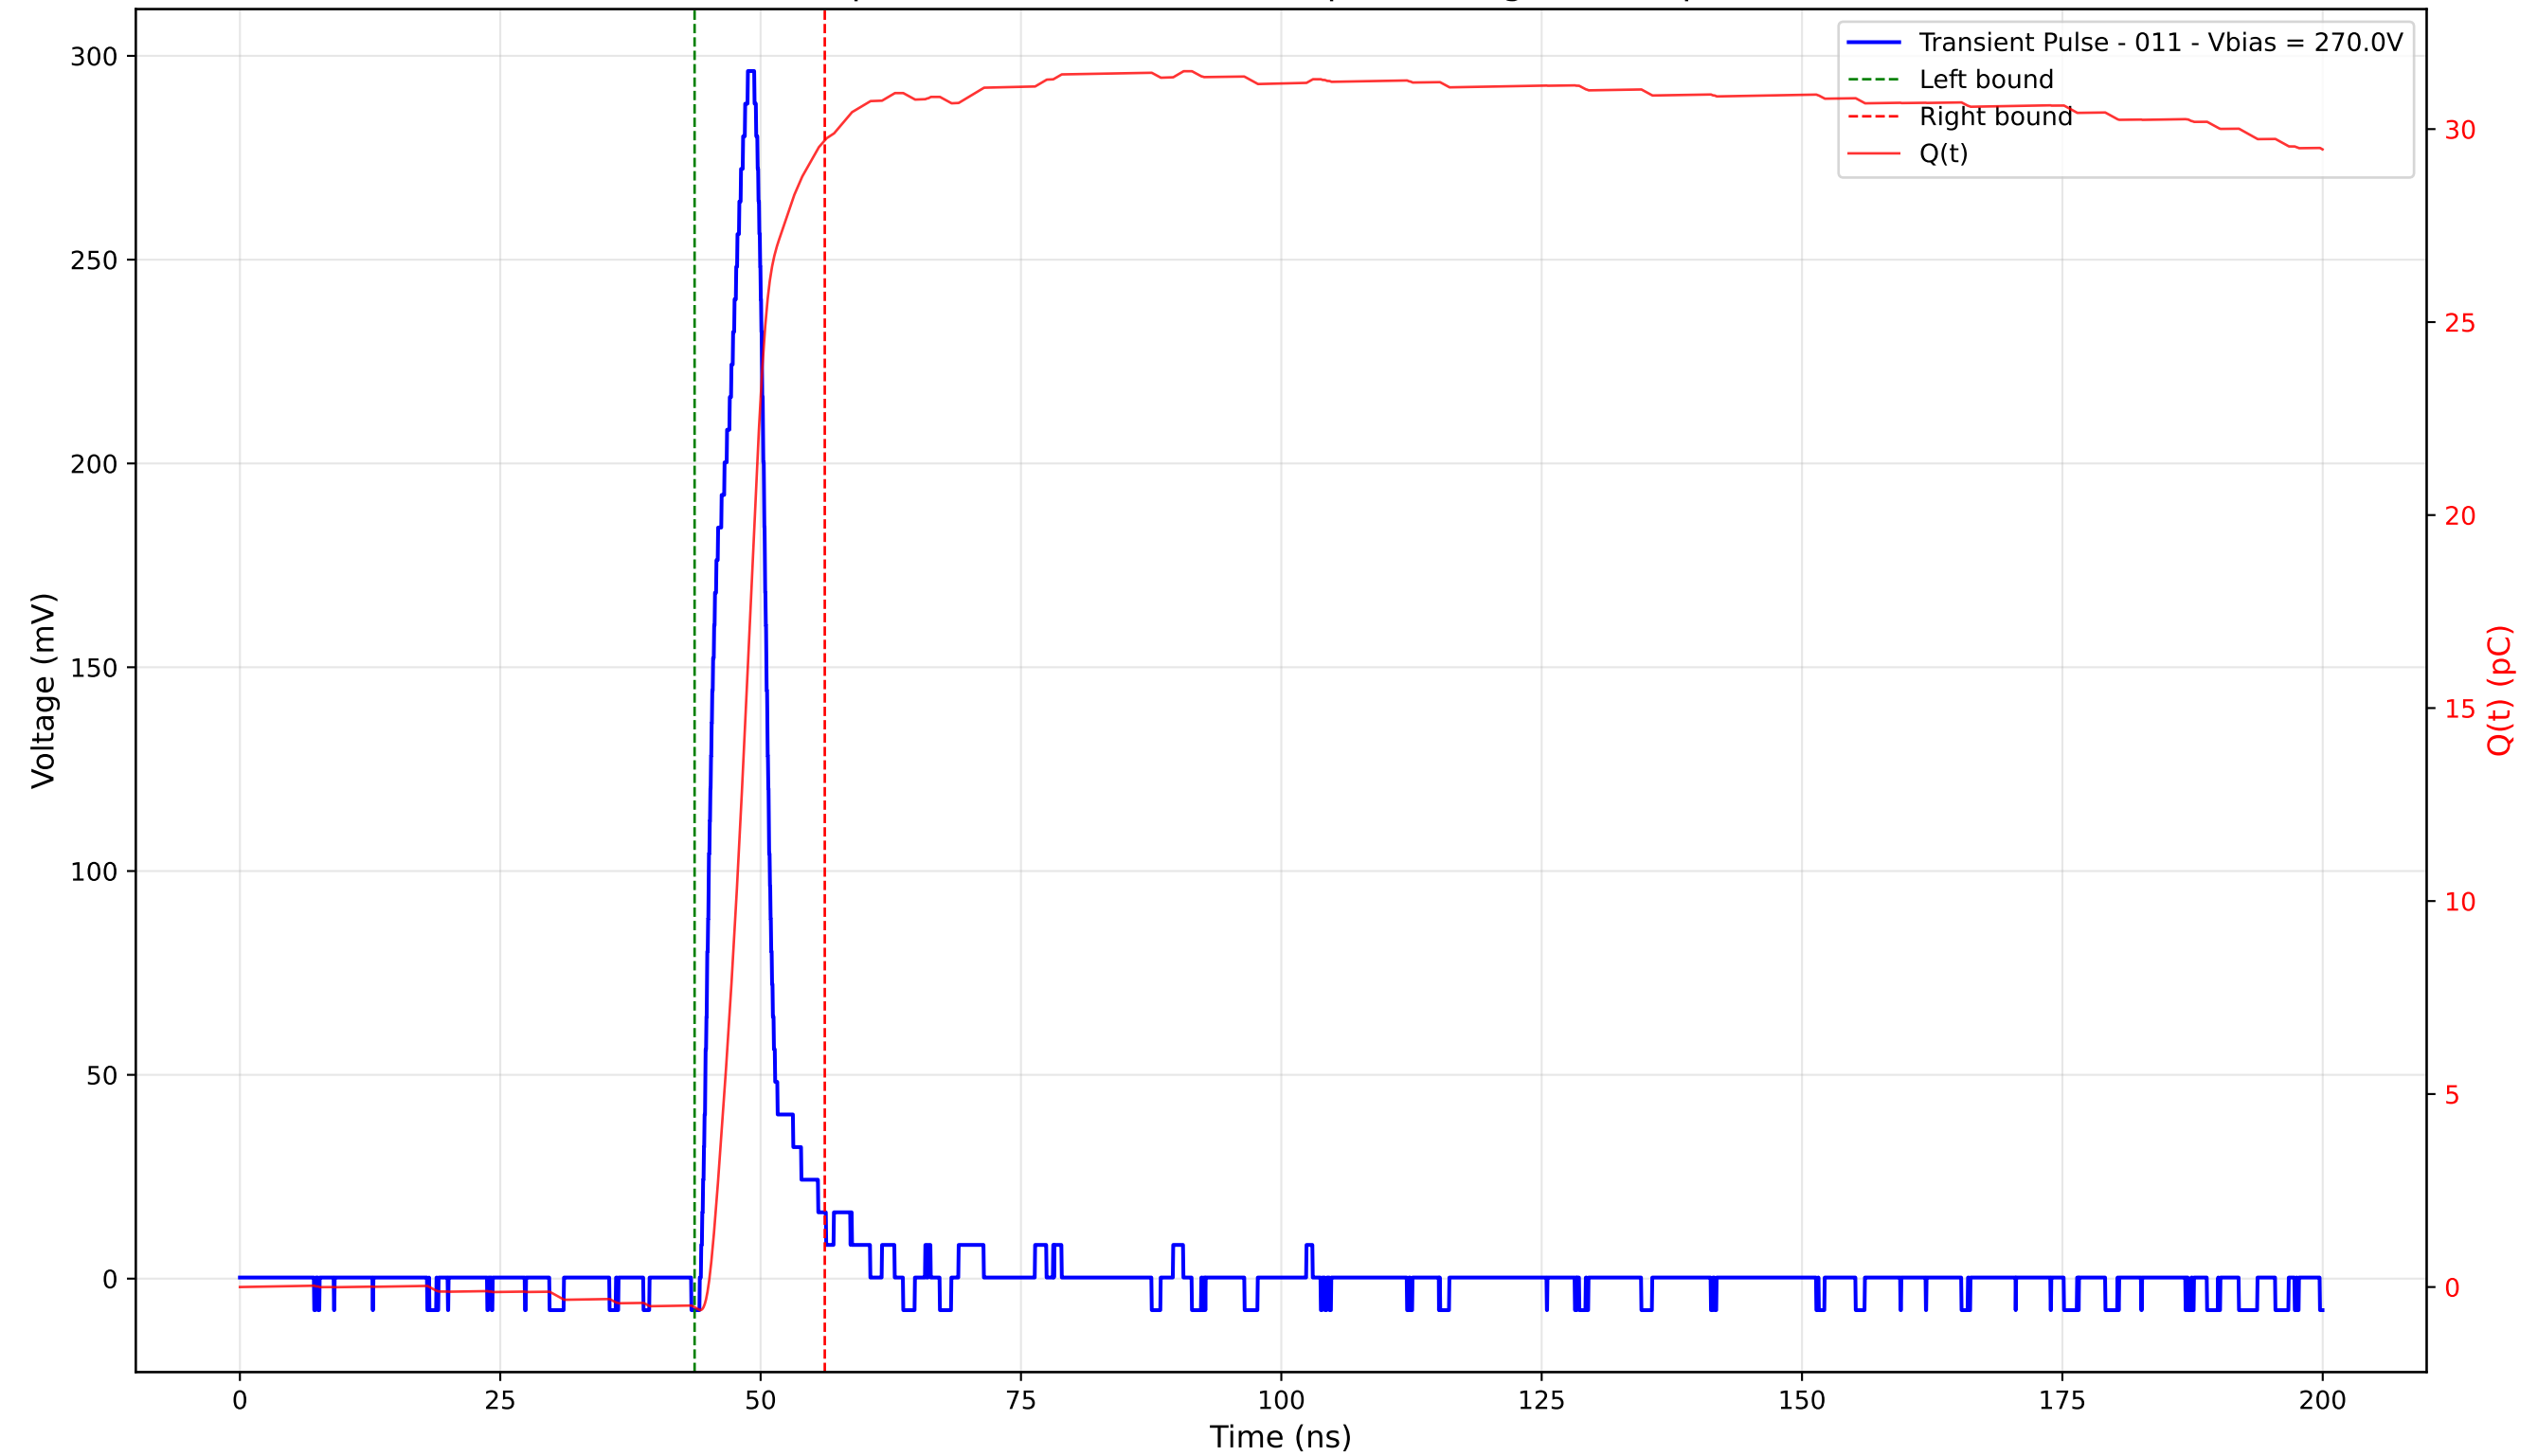


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 29.96 pC - Rise Time: 3.56 ns

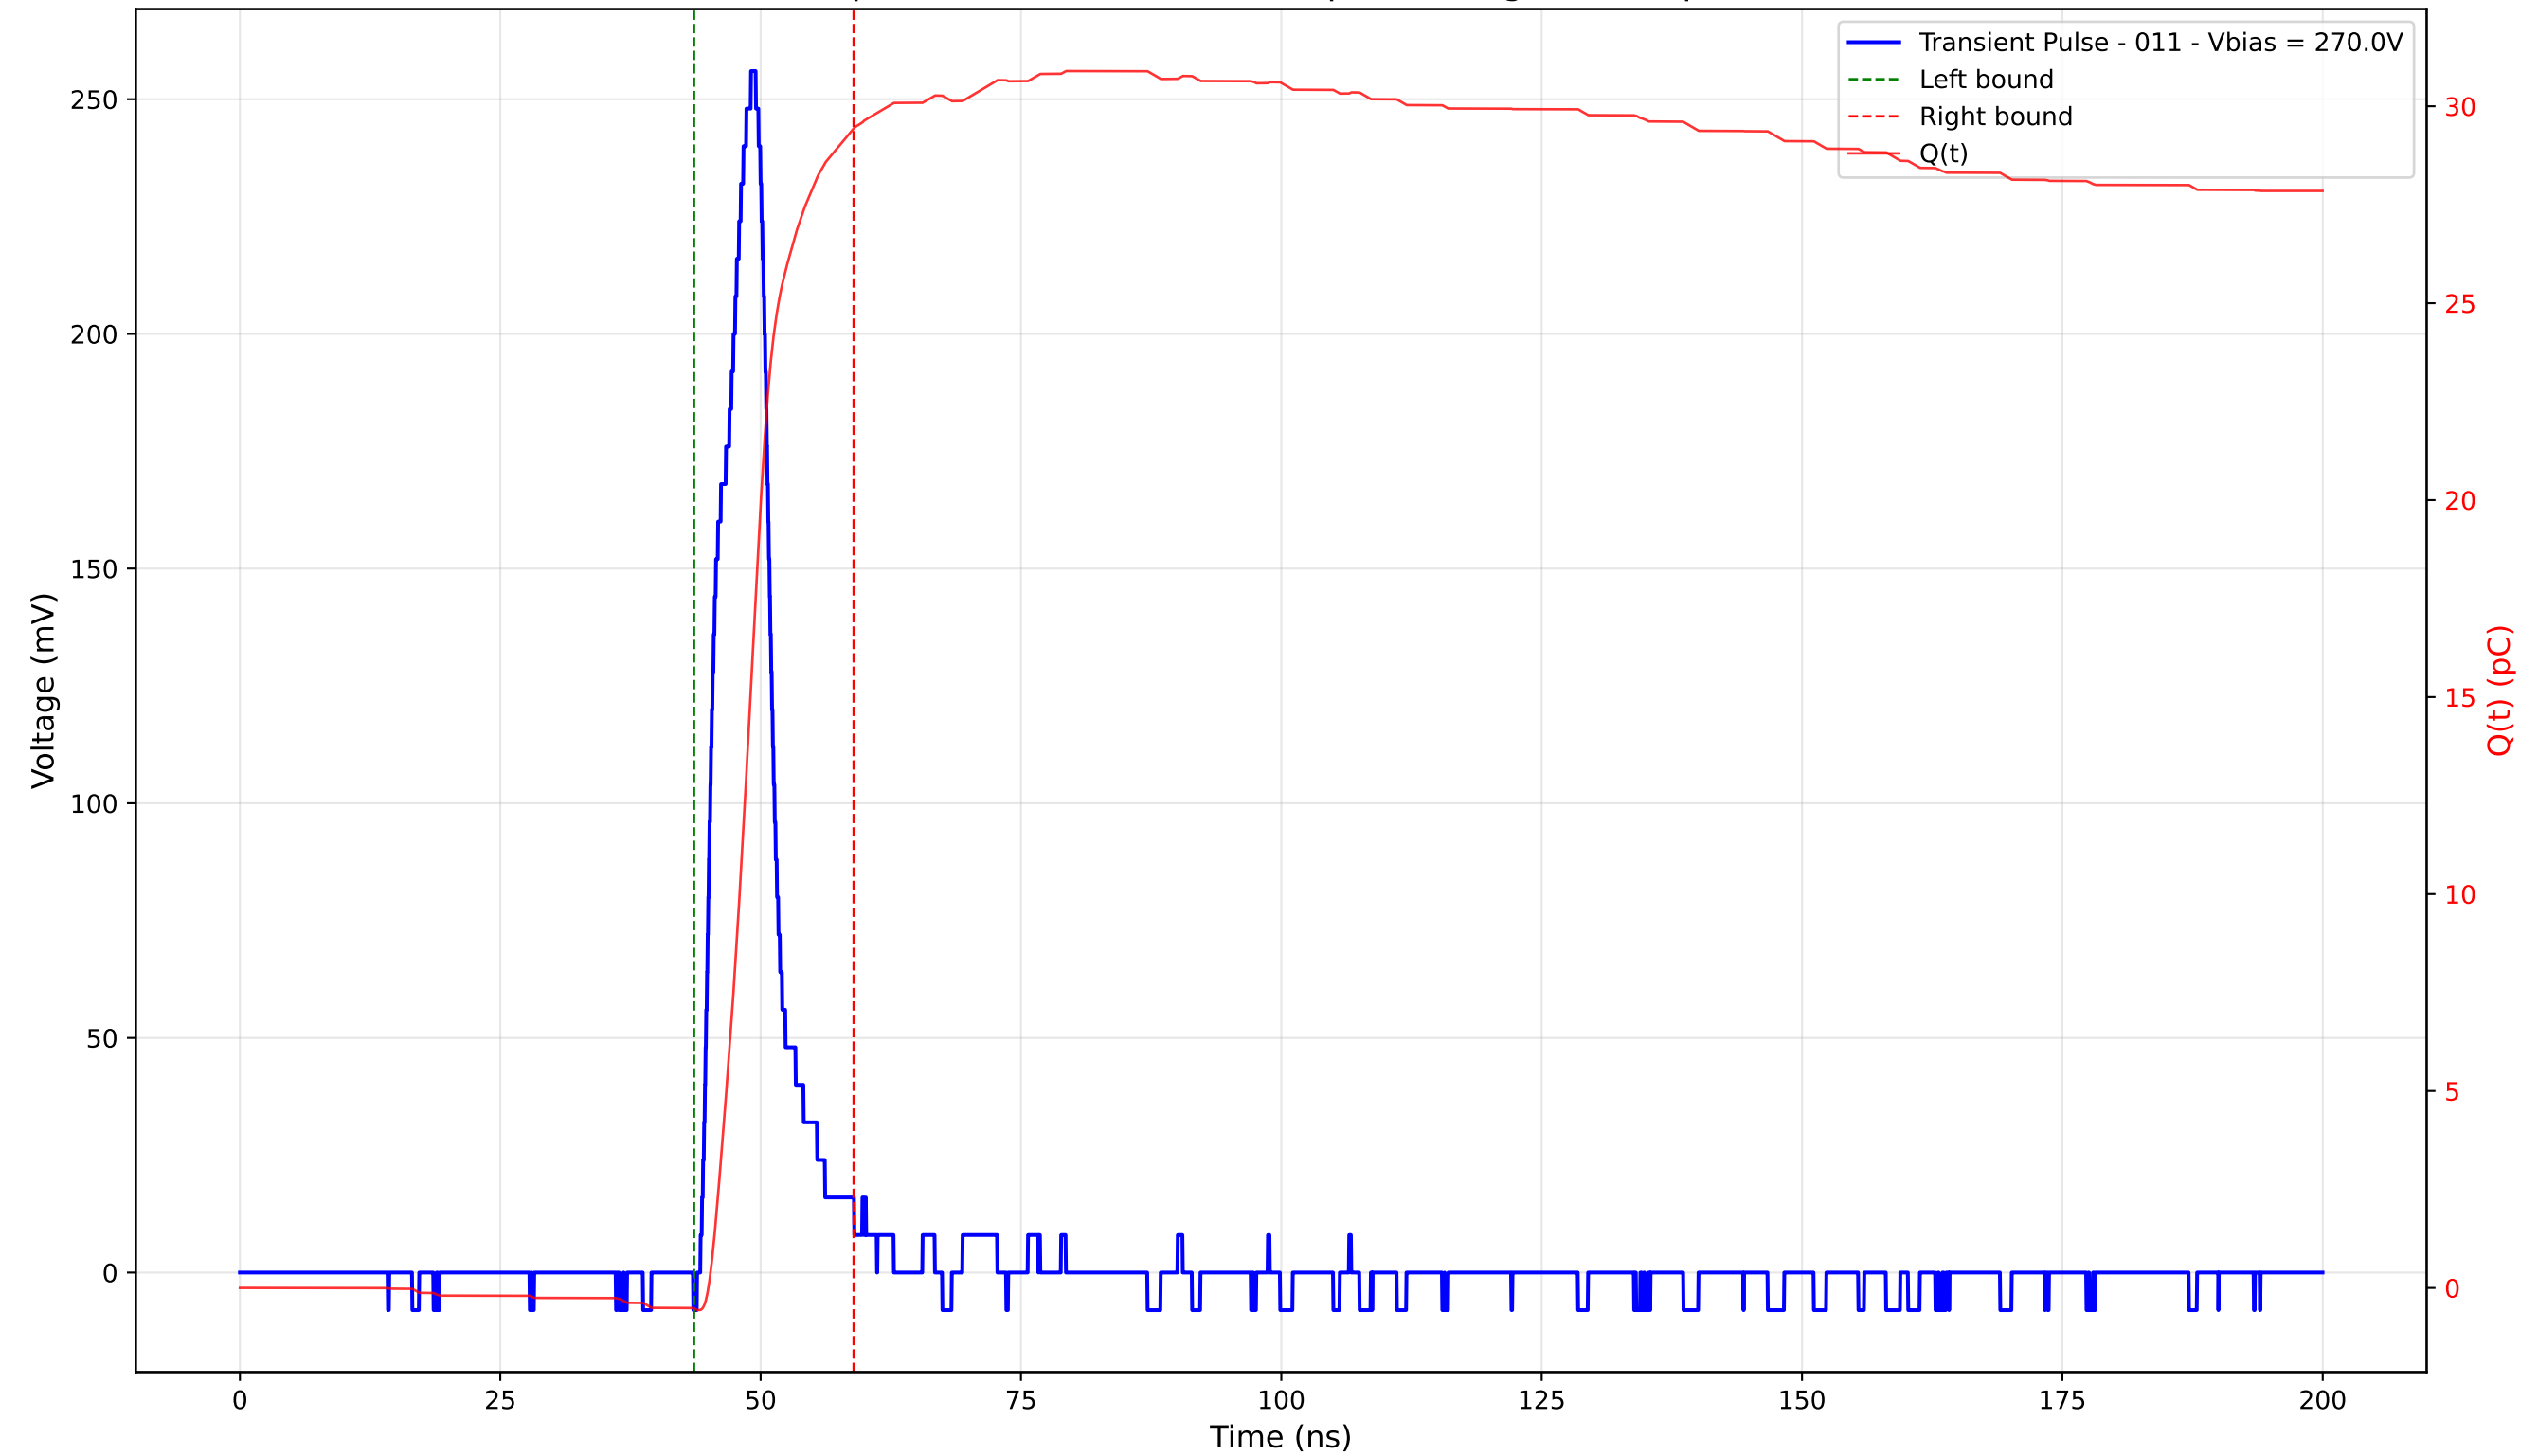


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 29.22 pC - Rise Time: 3.57 ns

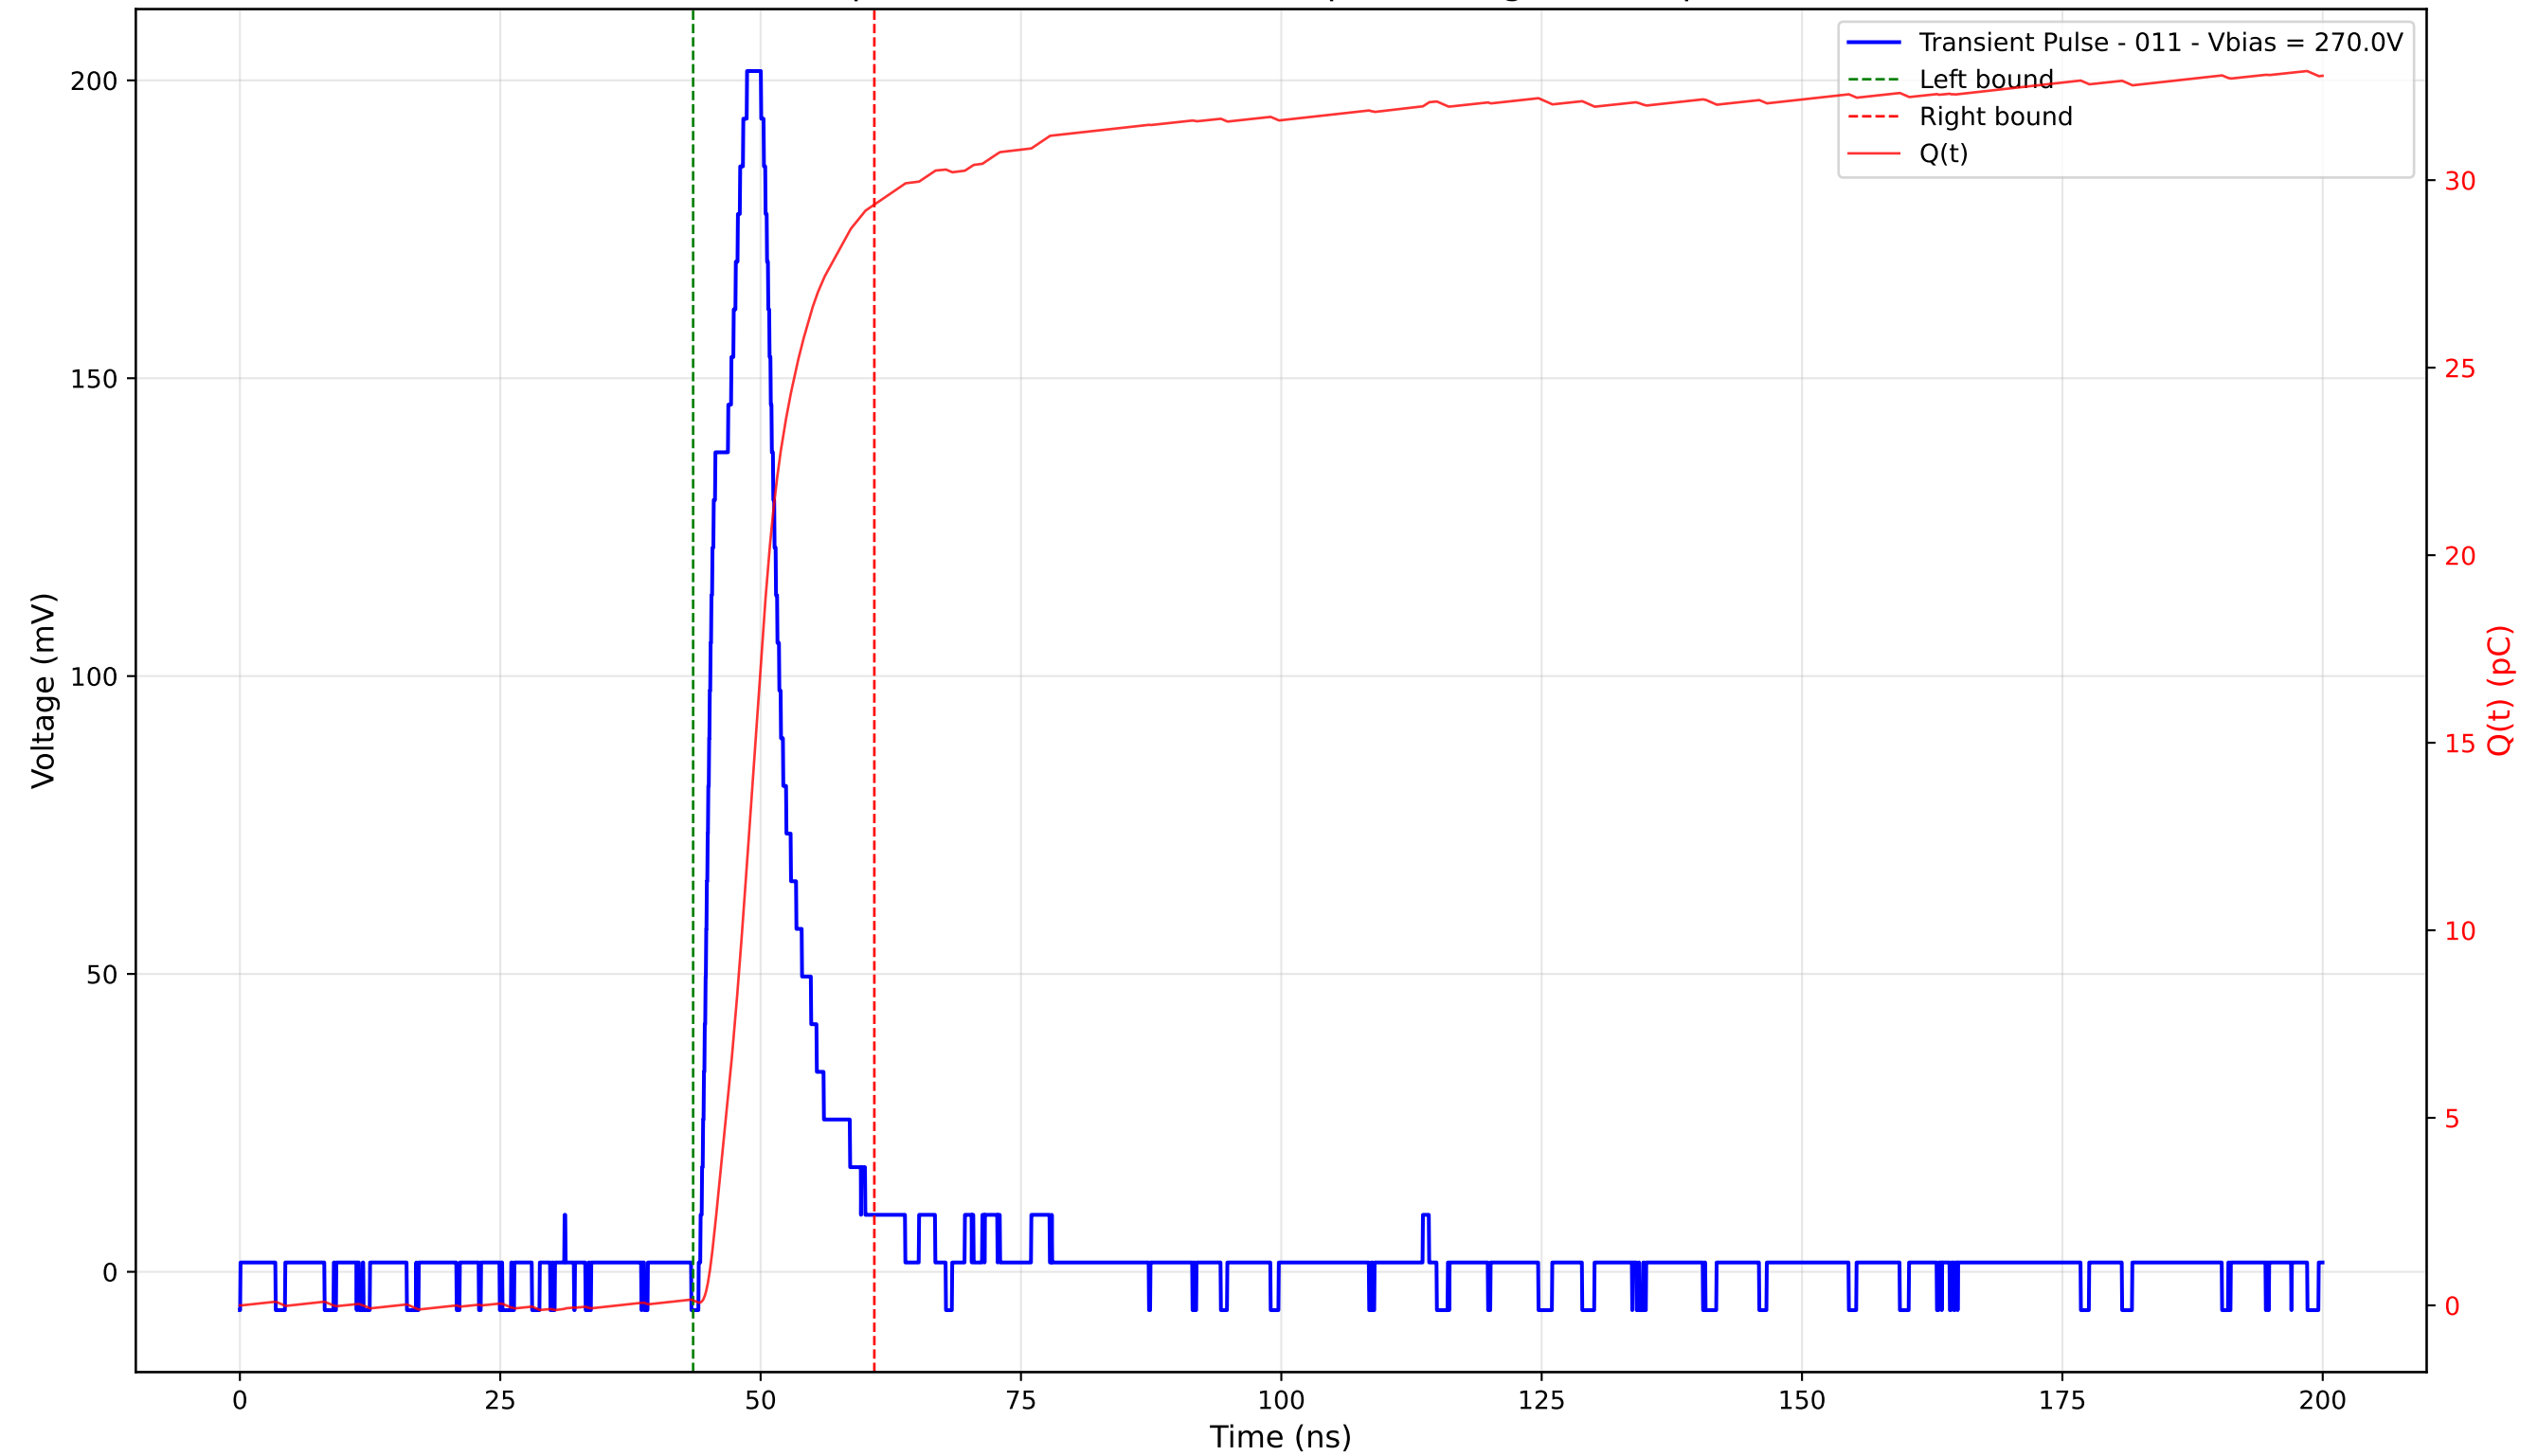


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 27.00 pC - Rise Time: 1.37 ns

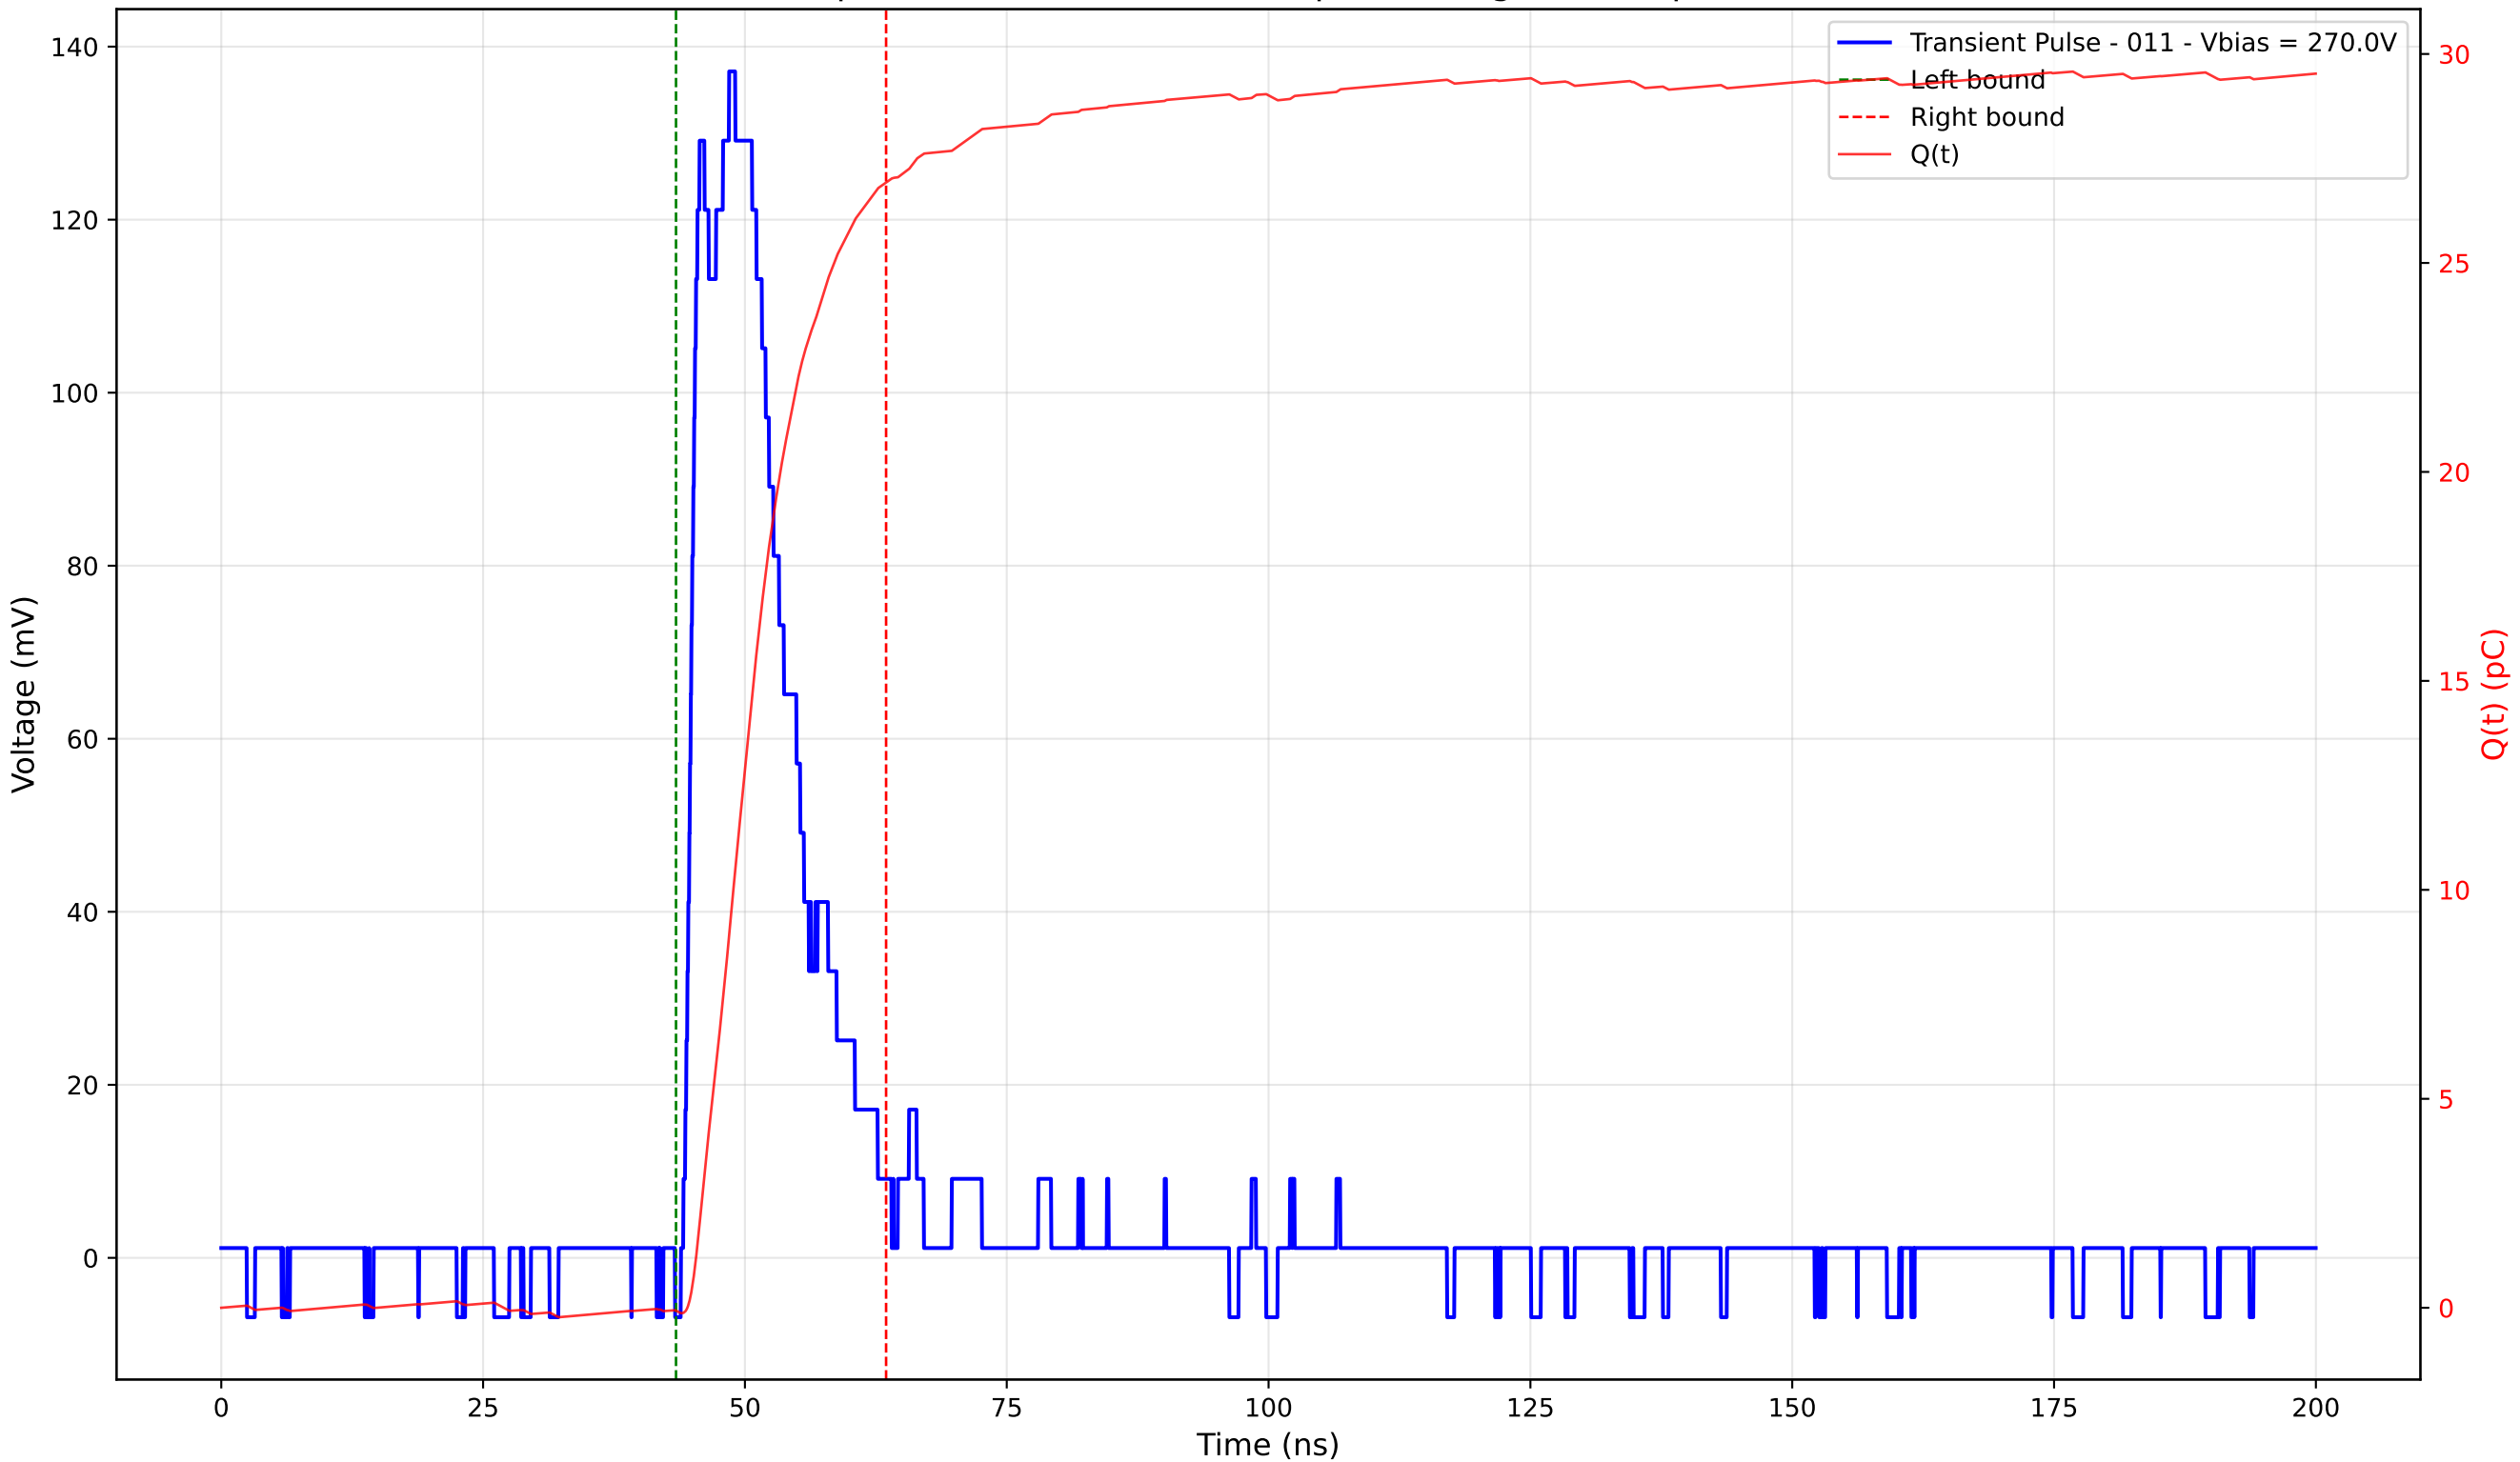


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 22.01 pC - Rise Time: 0.96 ns

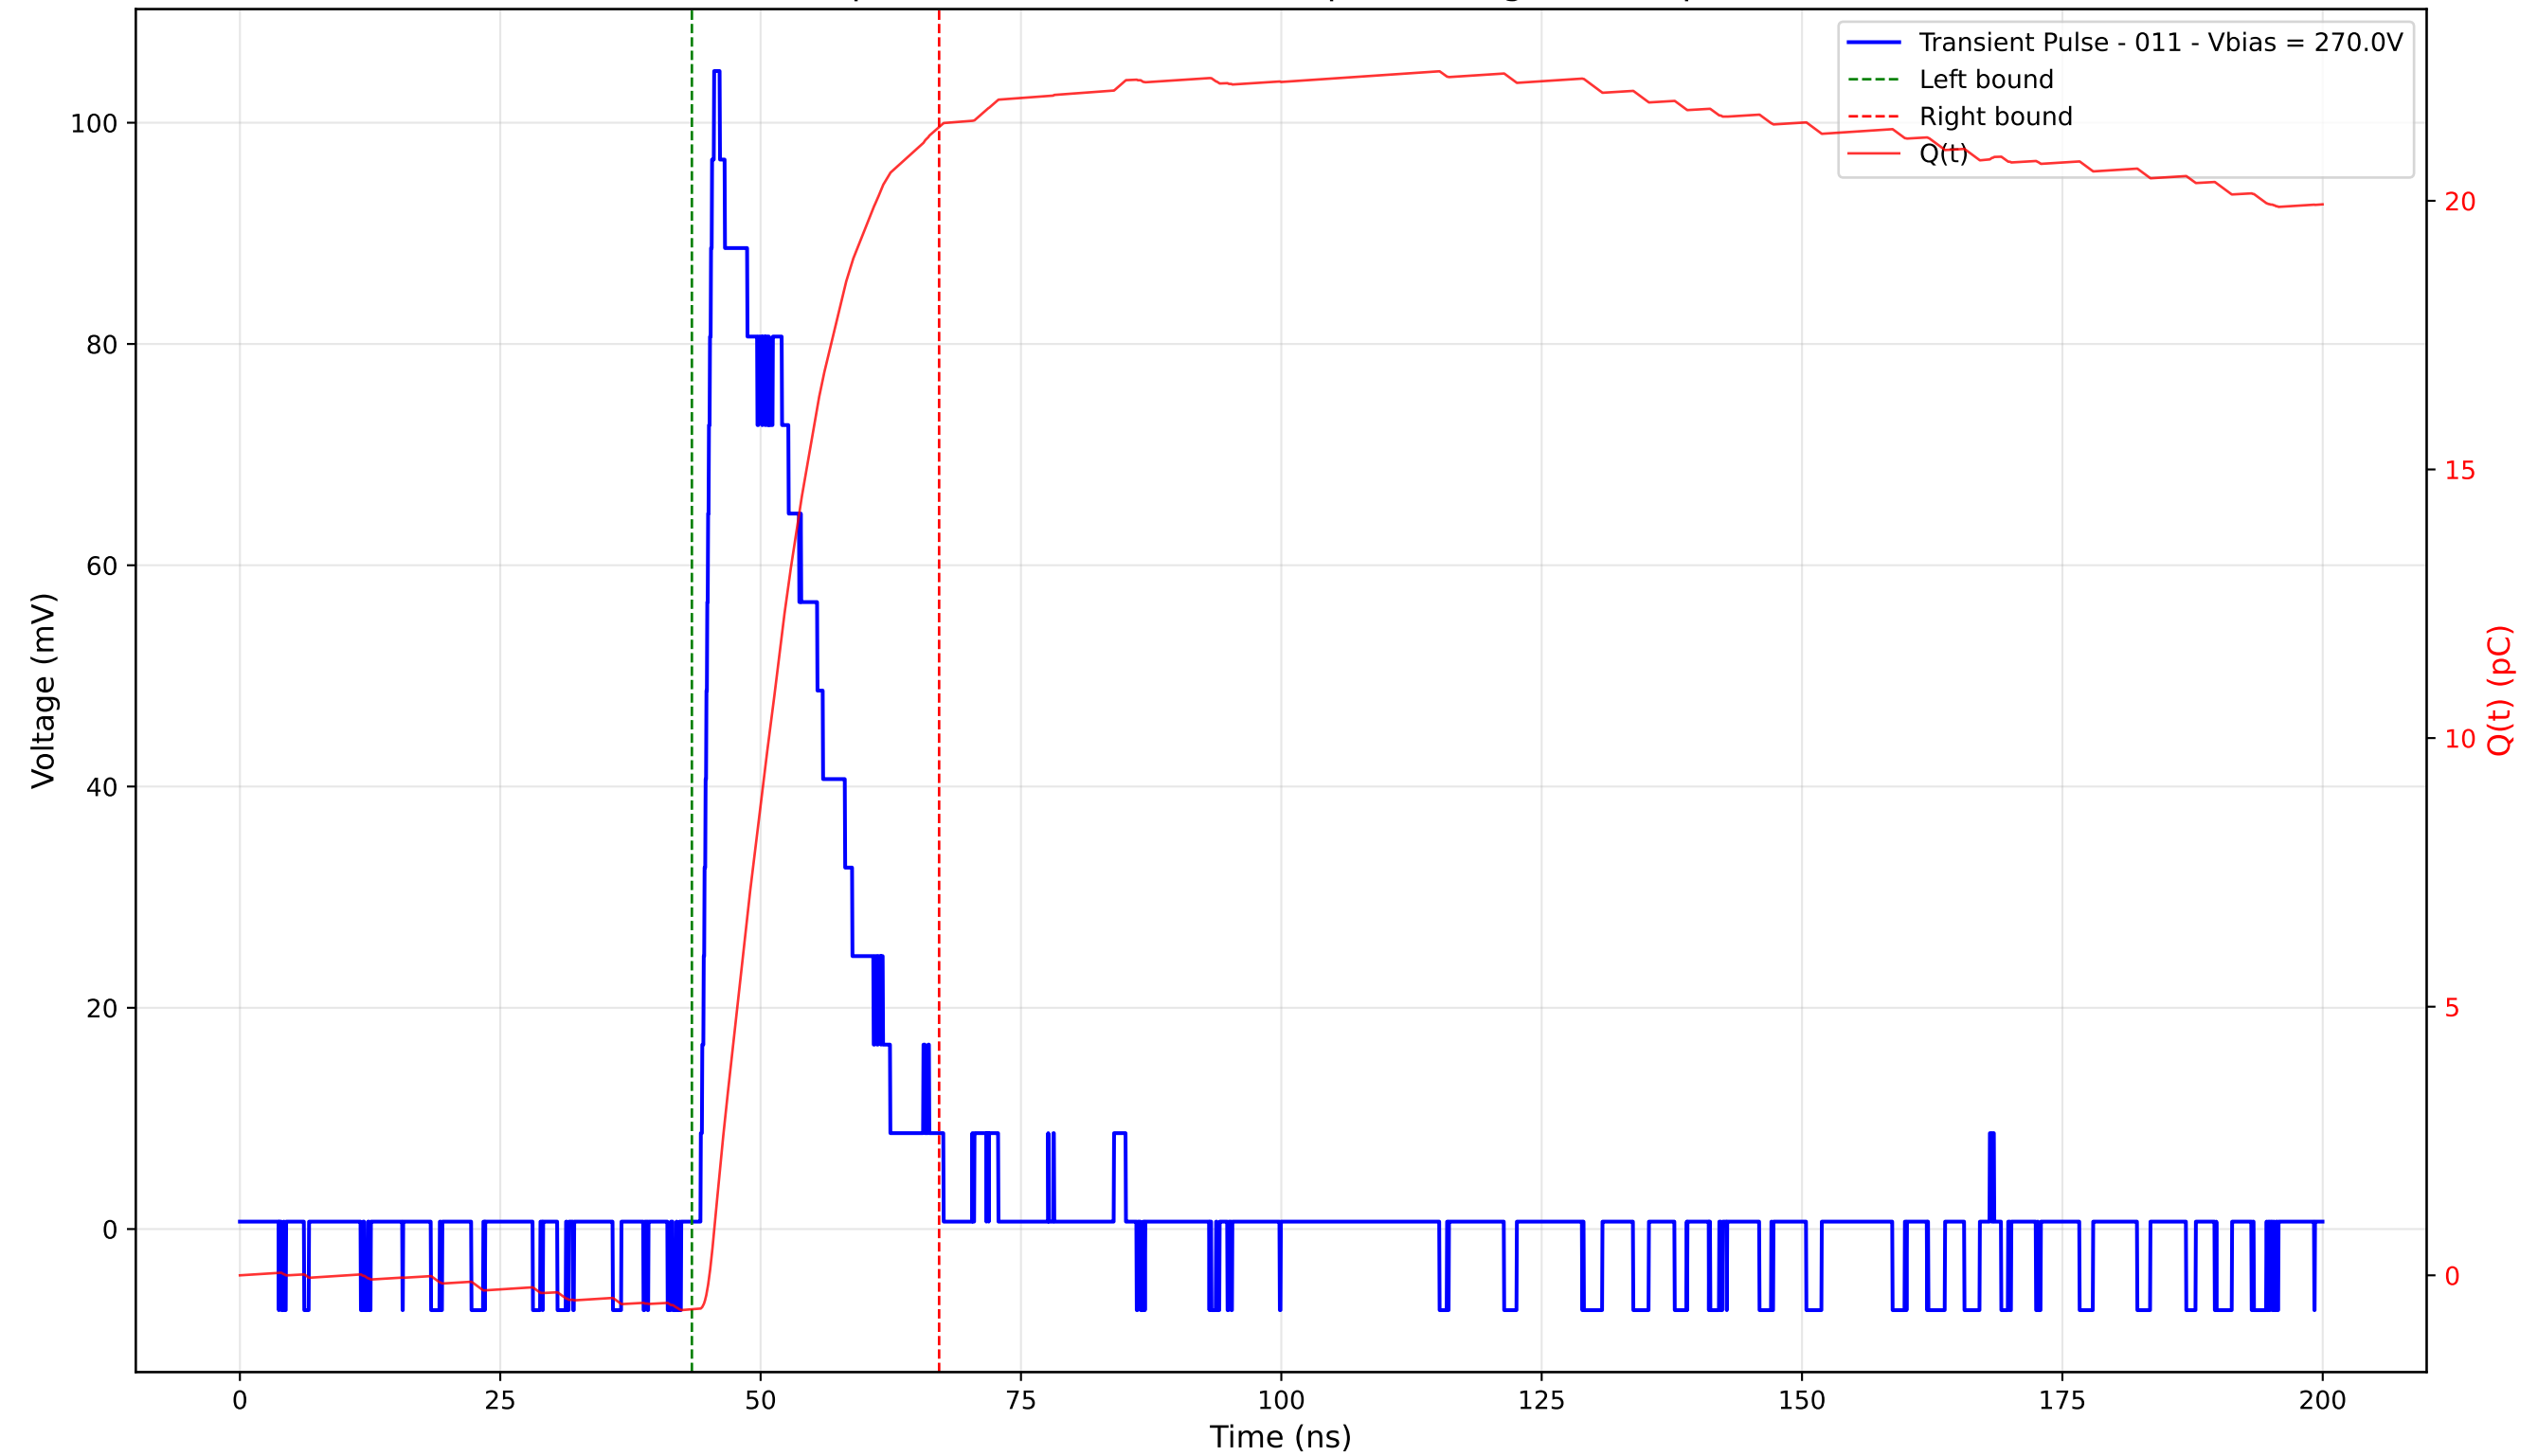


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 18.12 pC - Rise Time: 0.84 ns

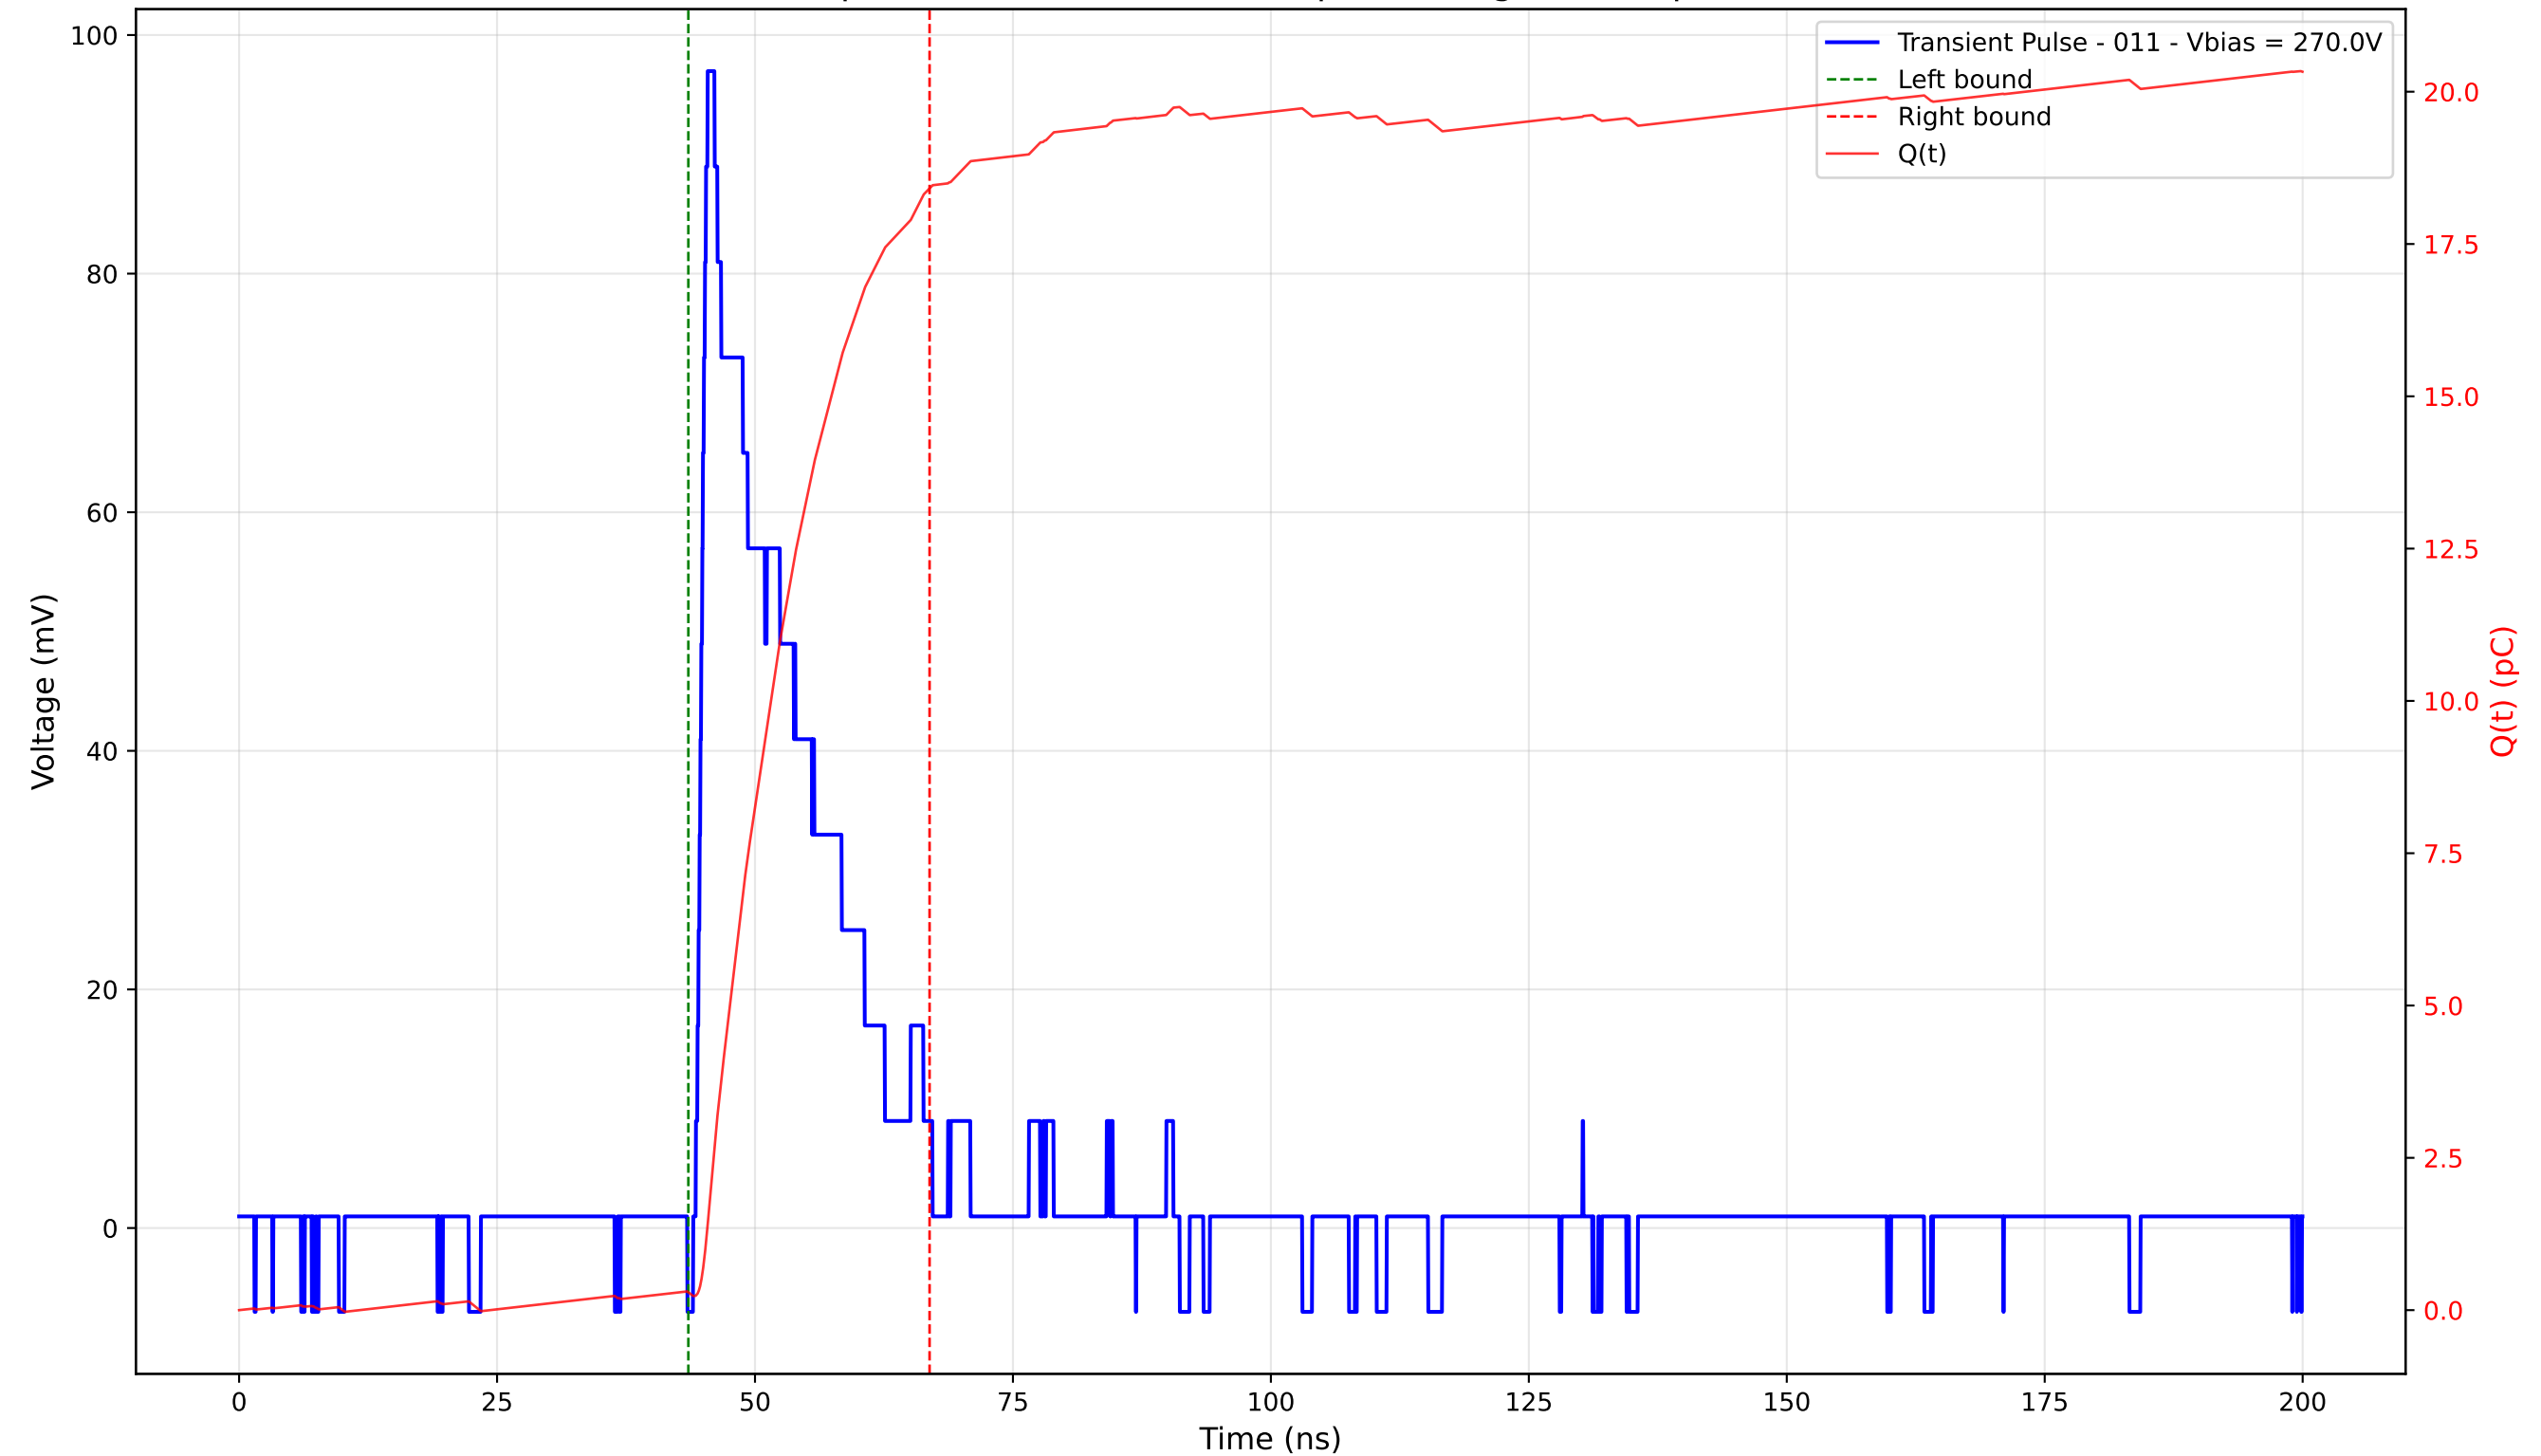


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 12.55 pC - Rise Time: 1.04 ns

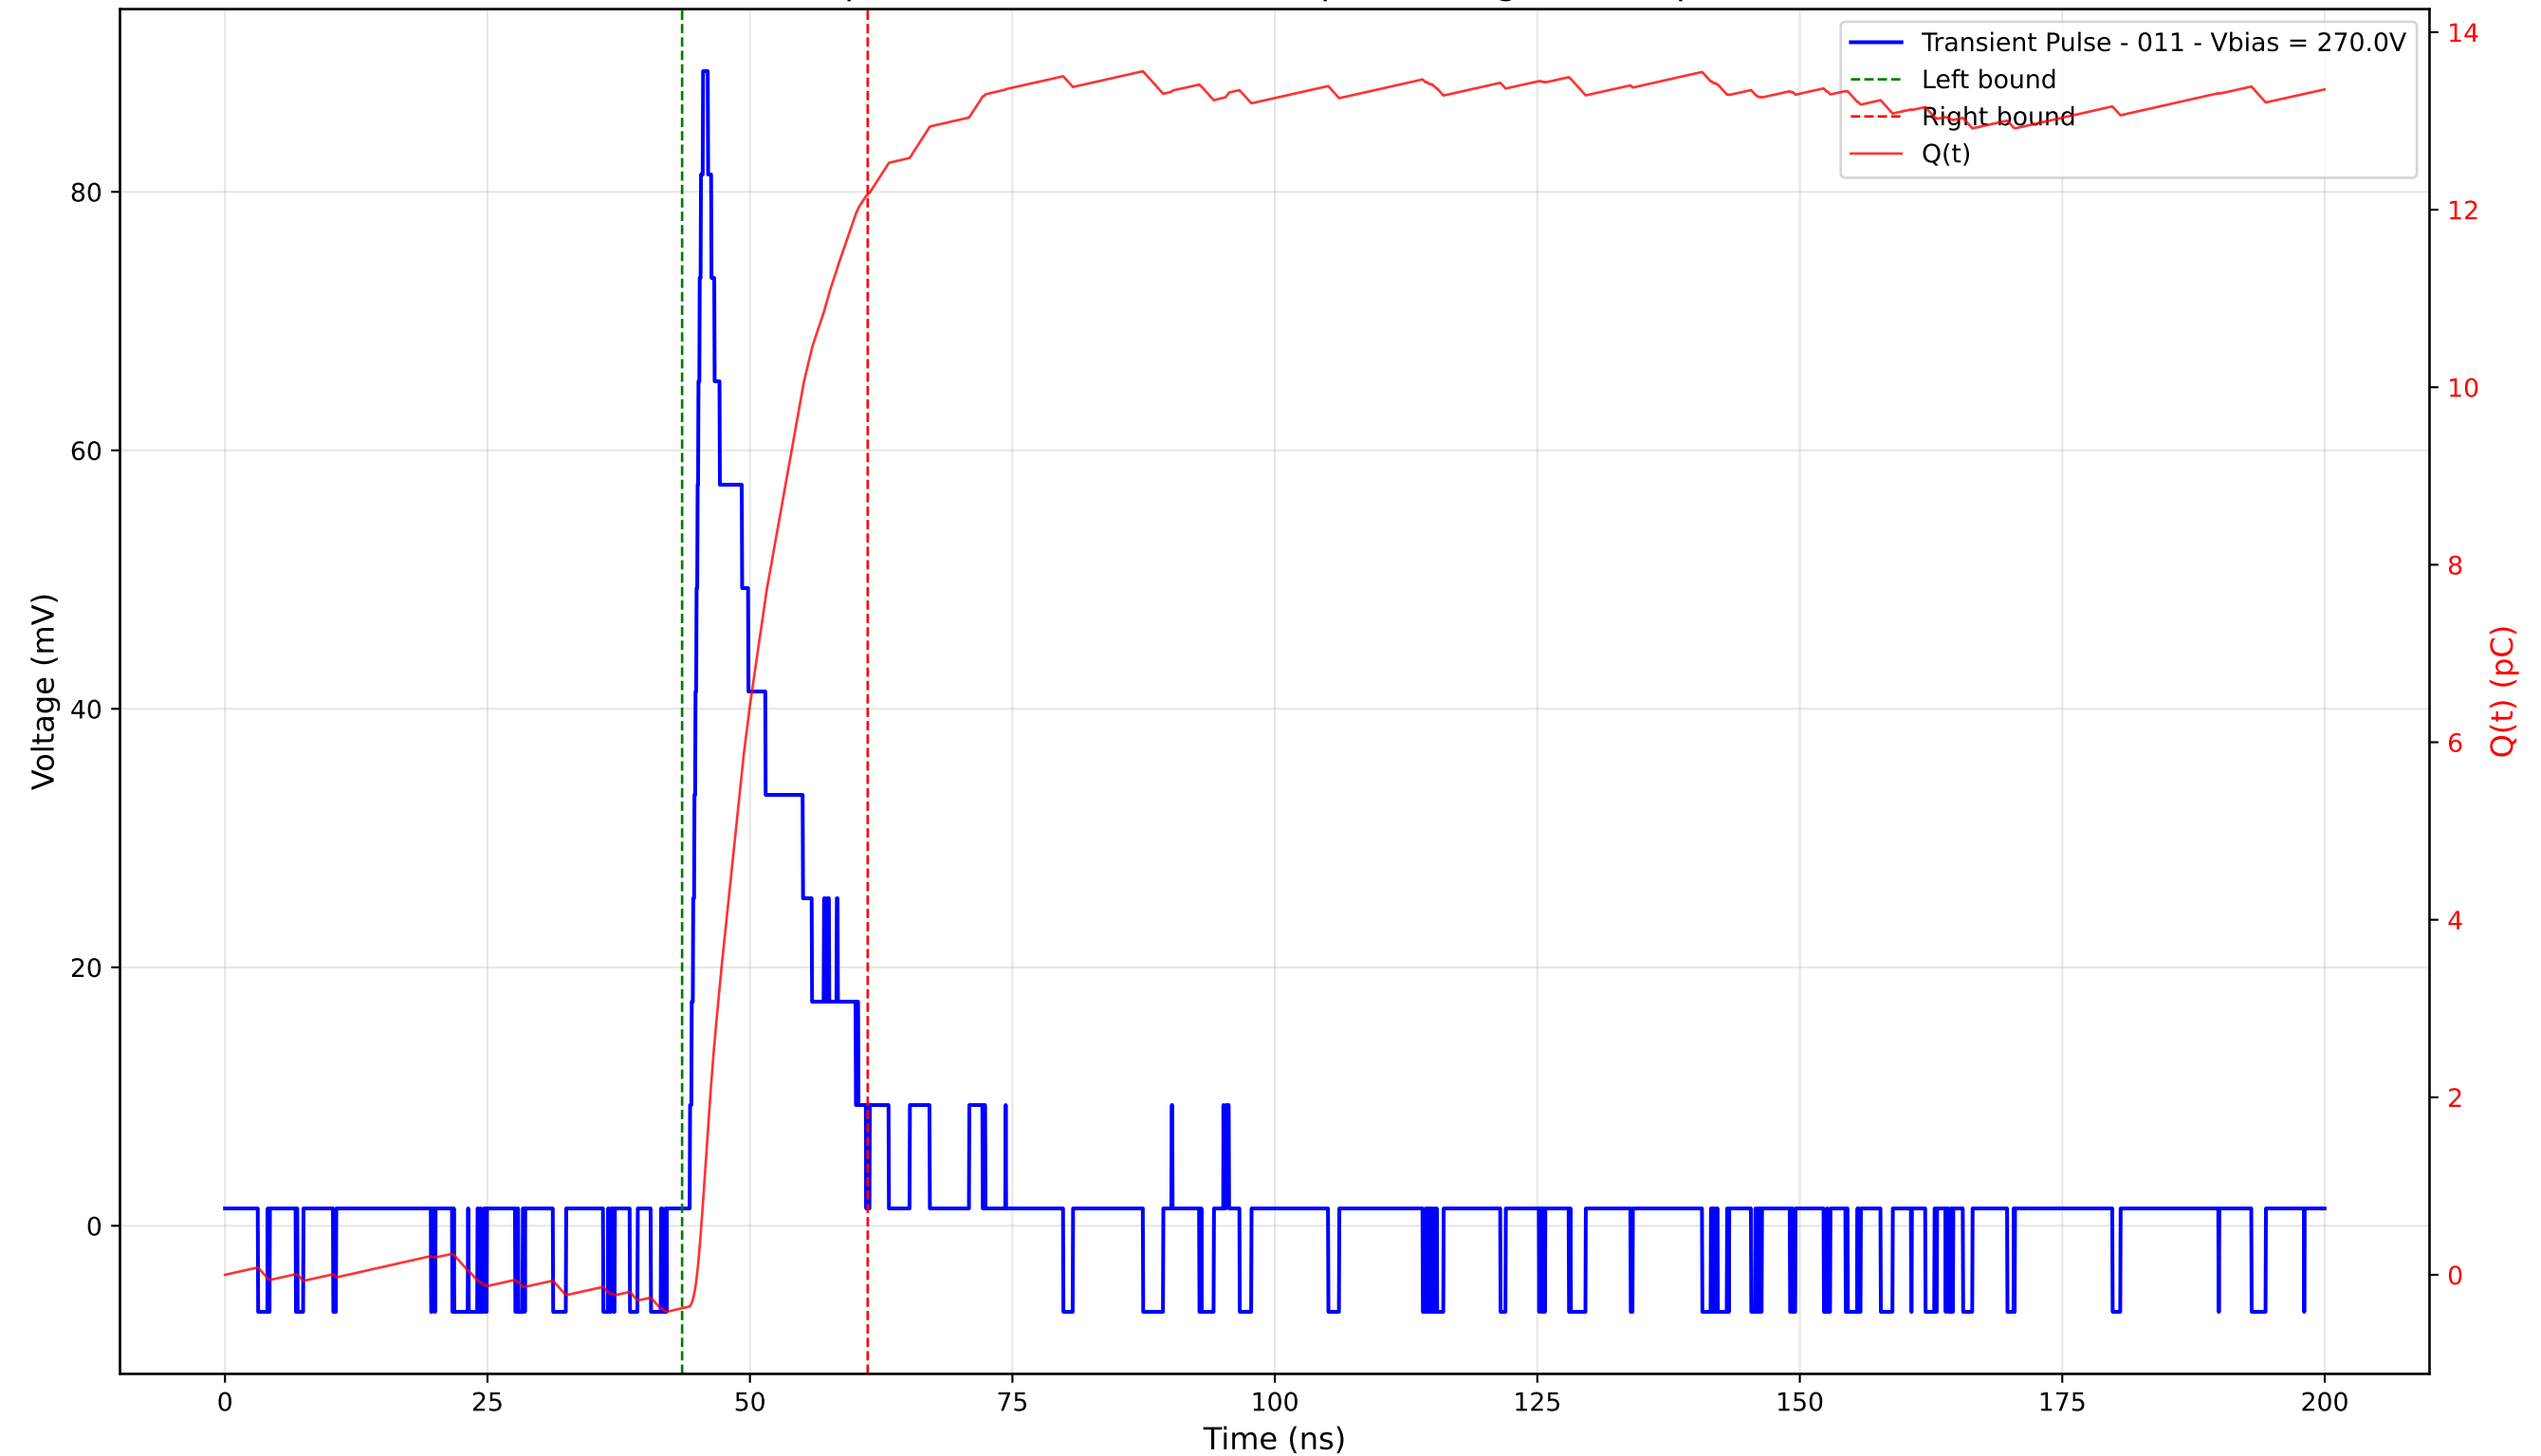


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 8.20 pC - Rise Time: 1.06 ns

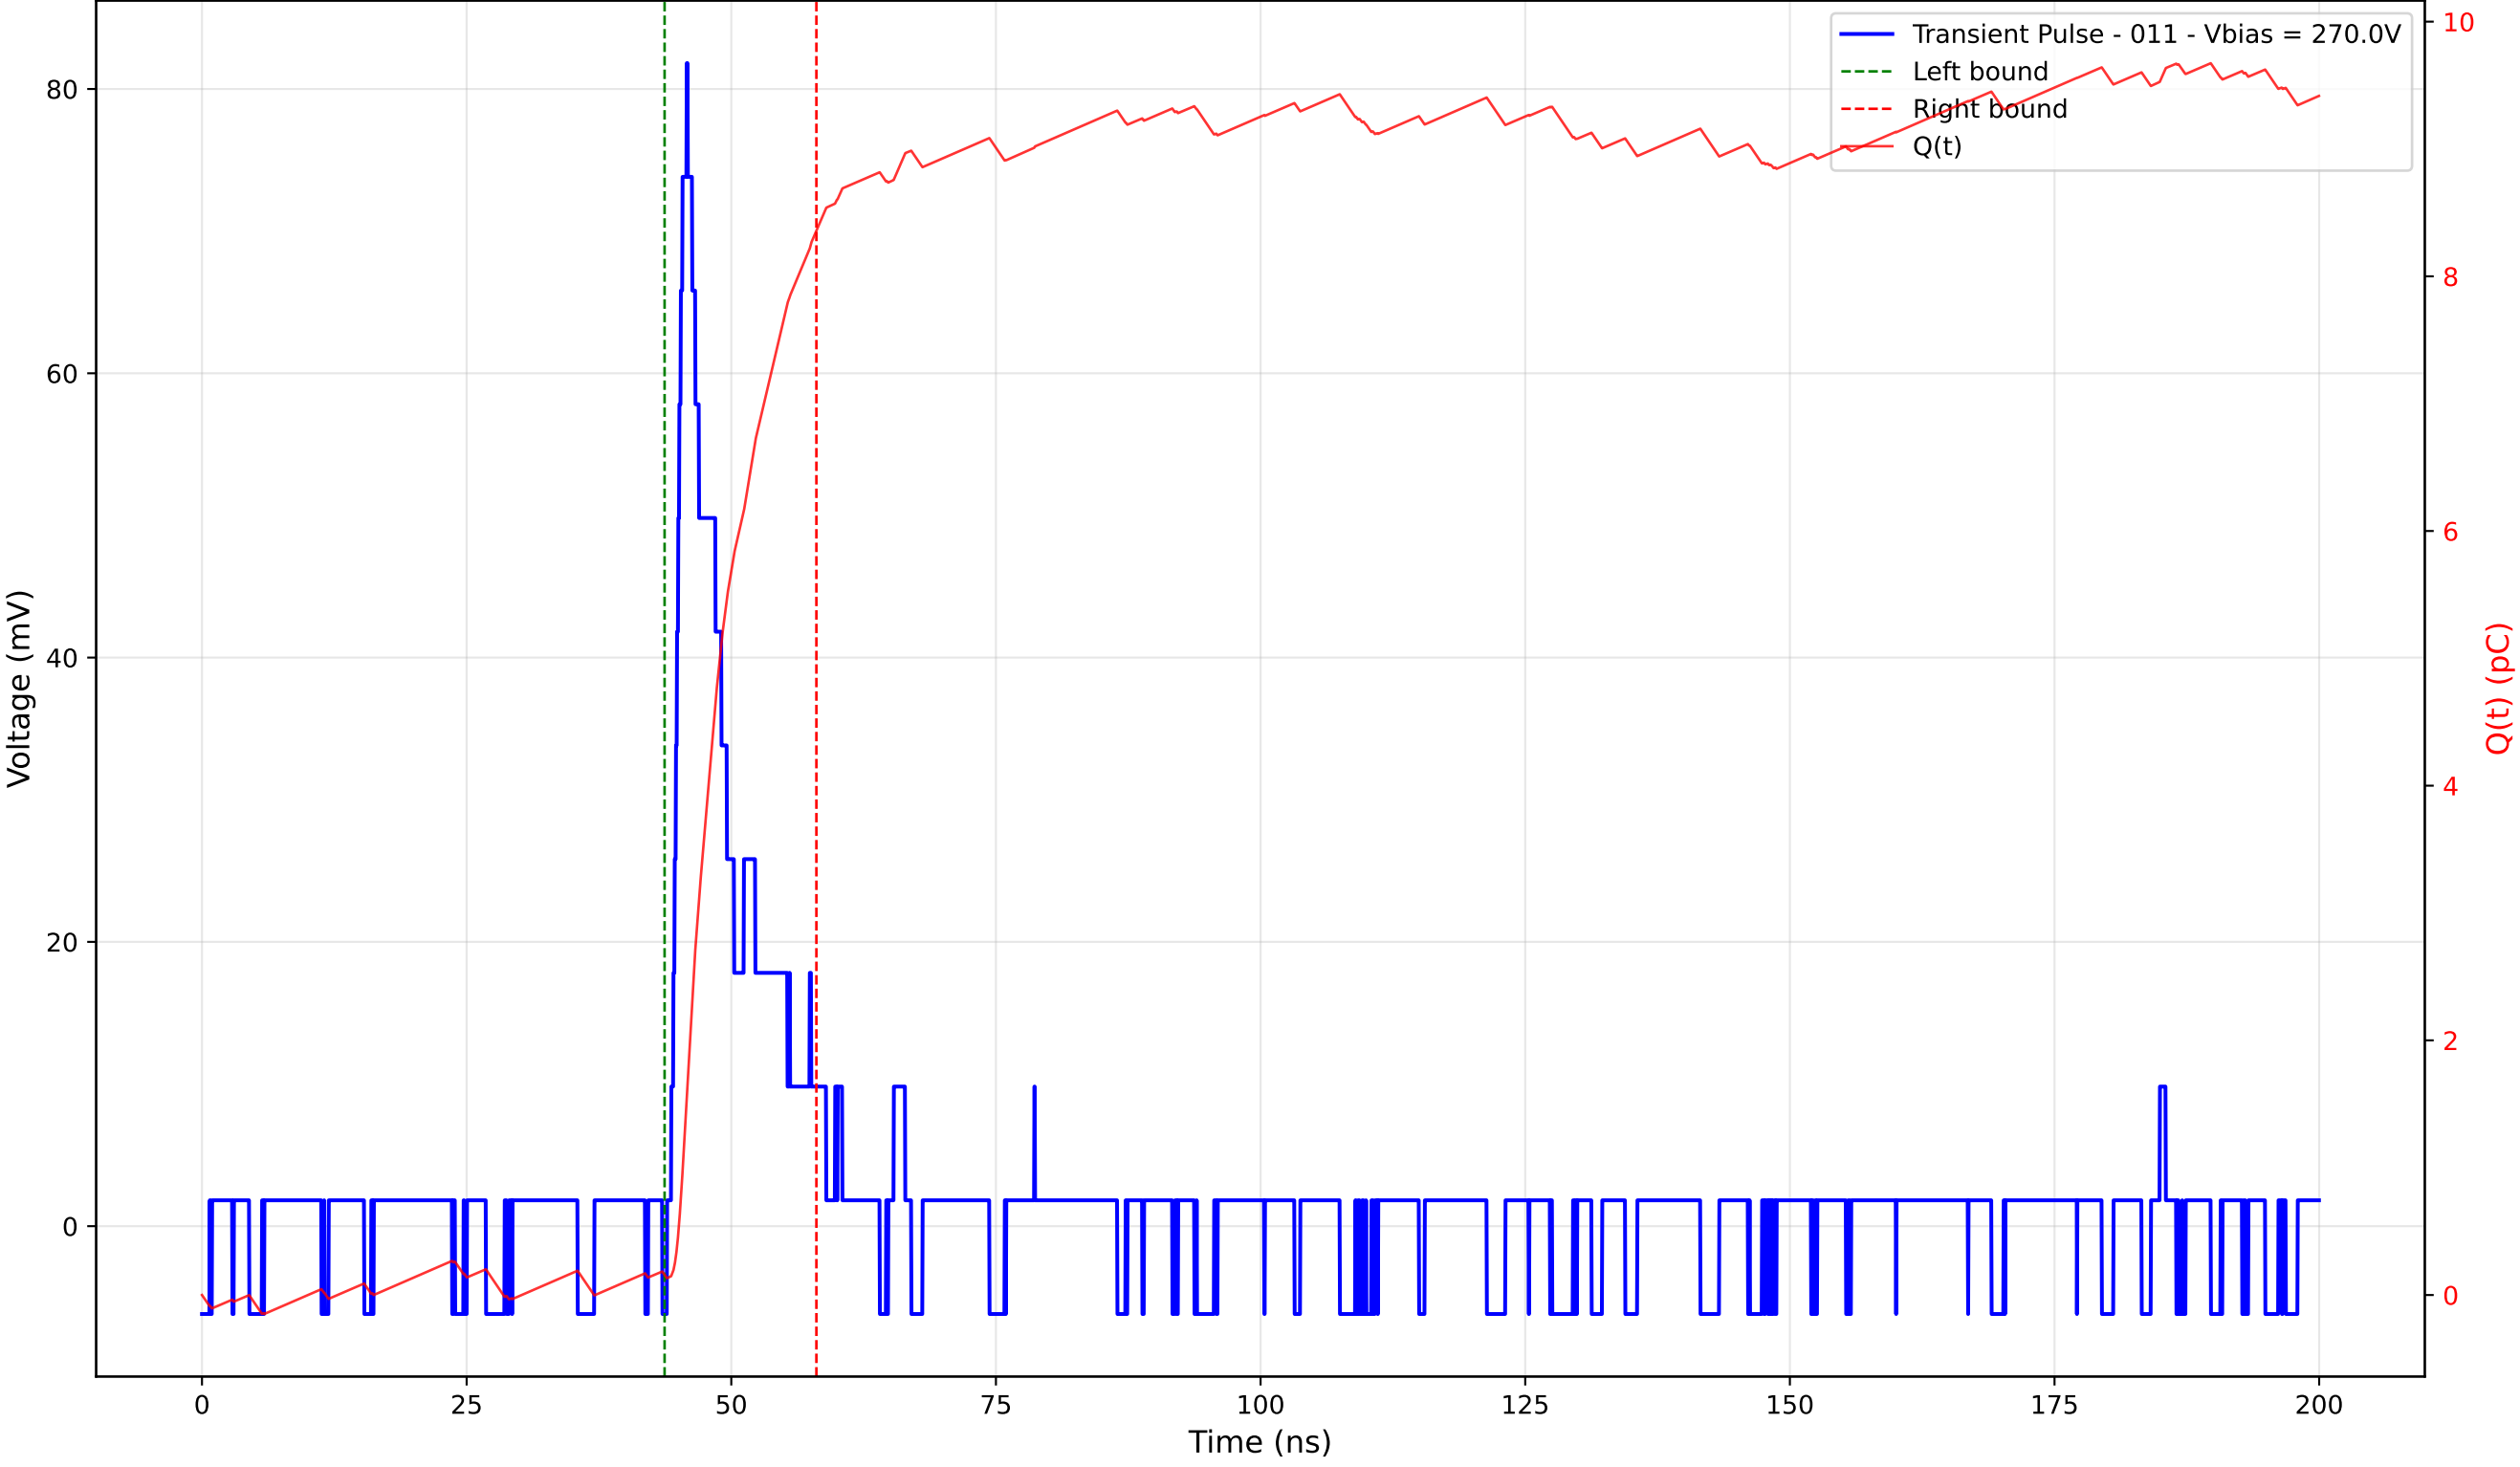


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 3.81 pC - Rise Time: 0.85 ns

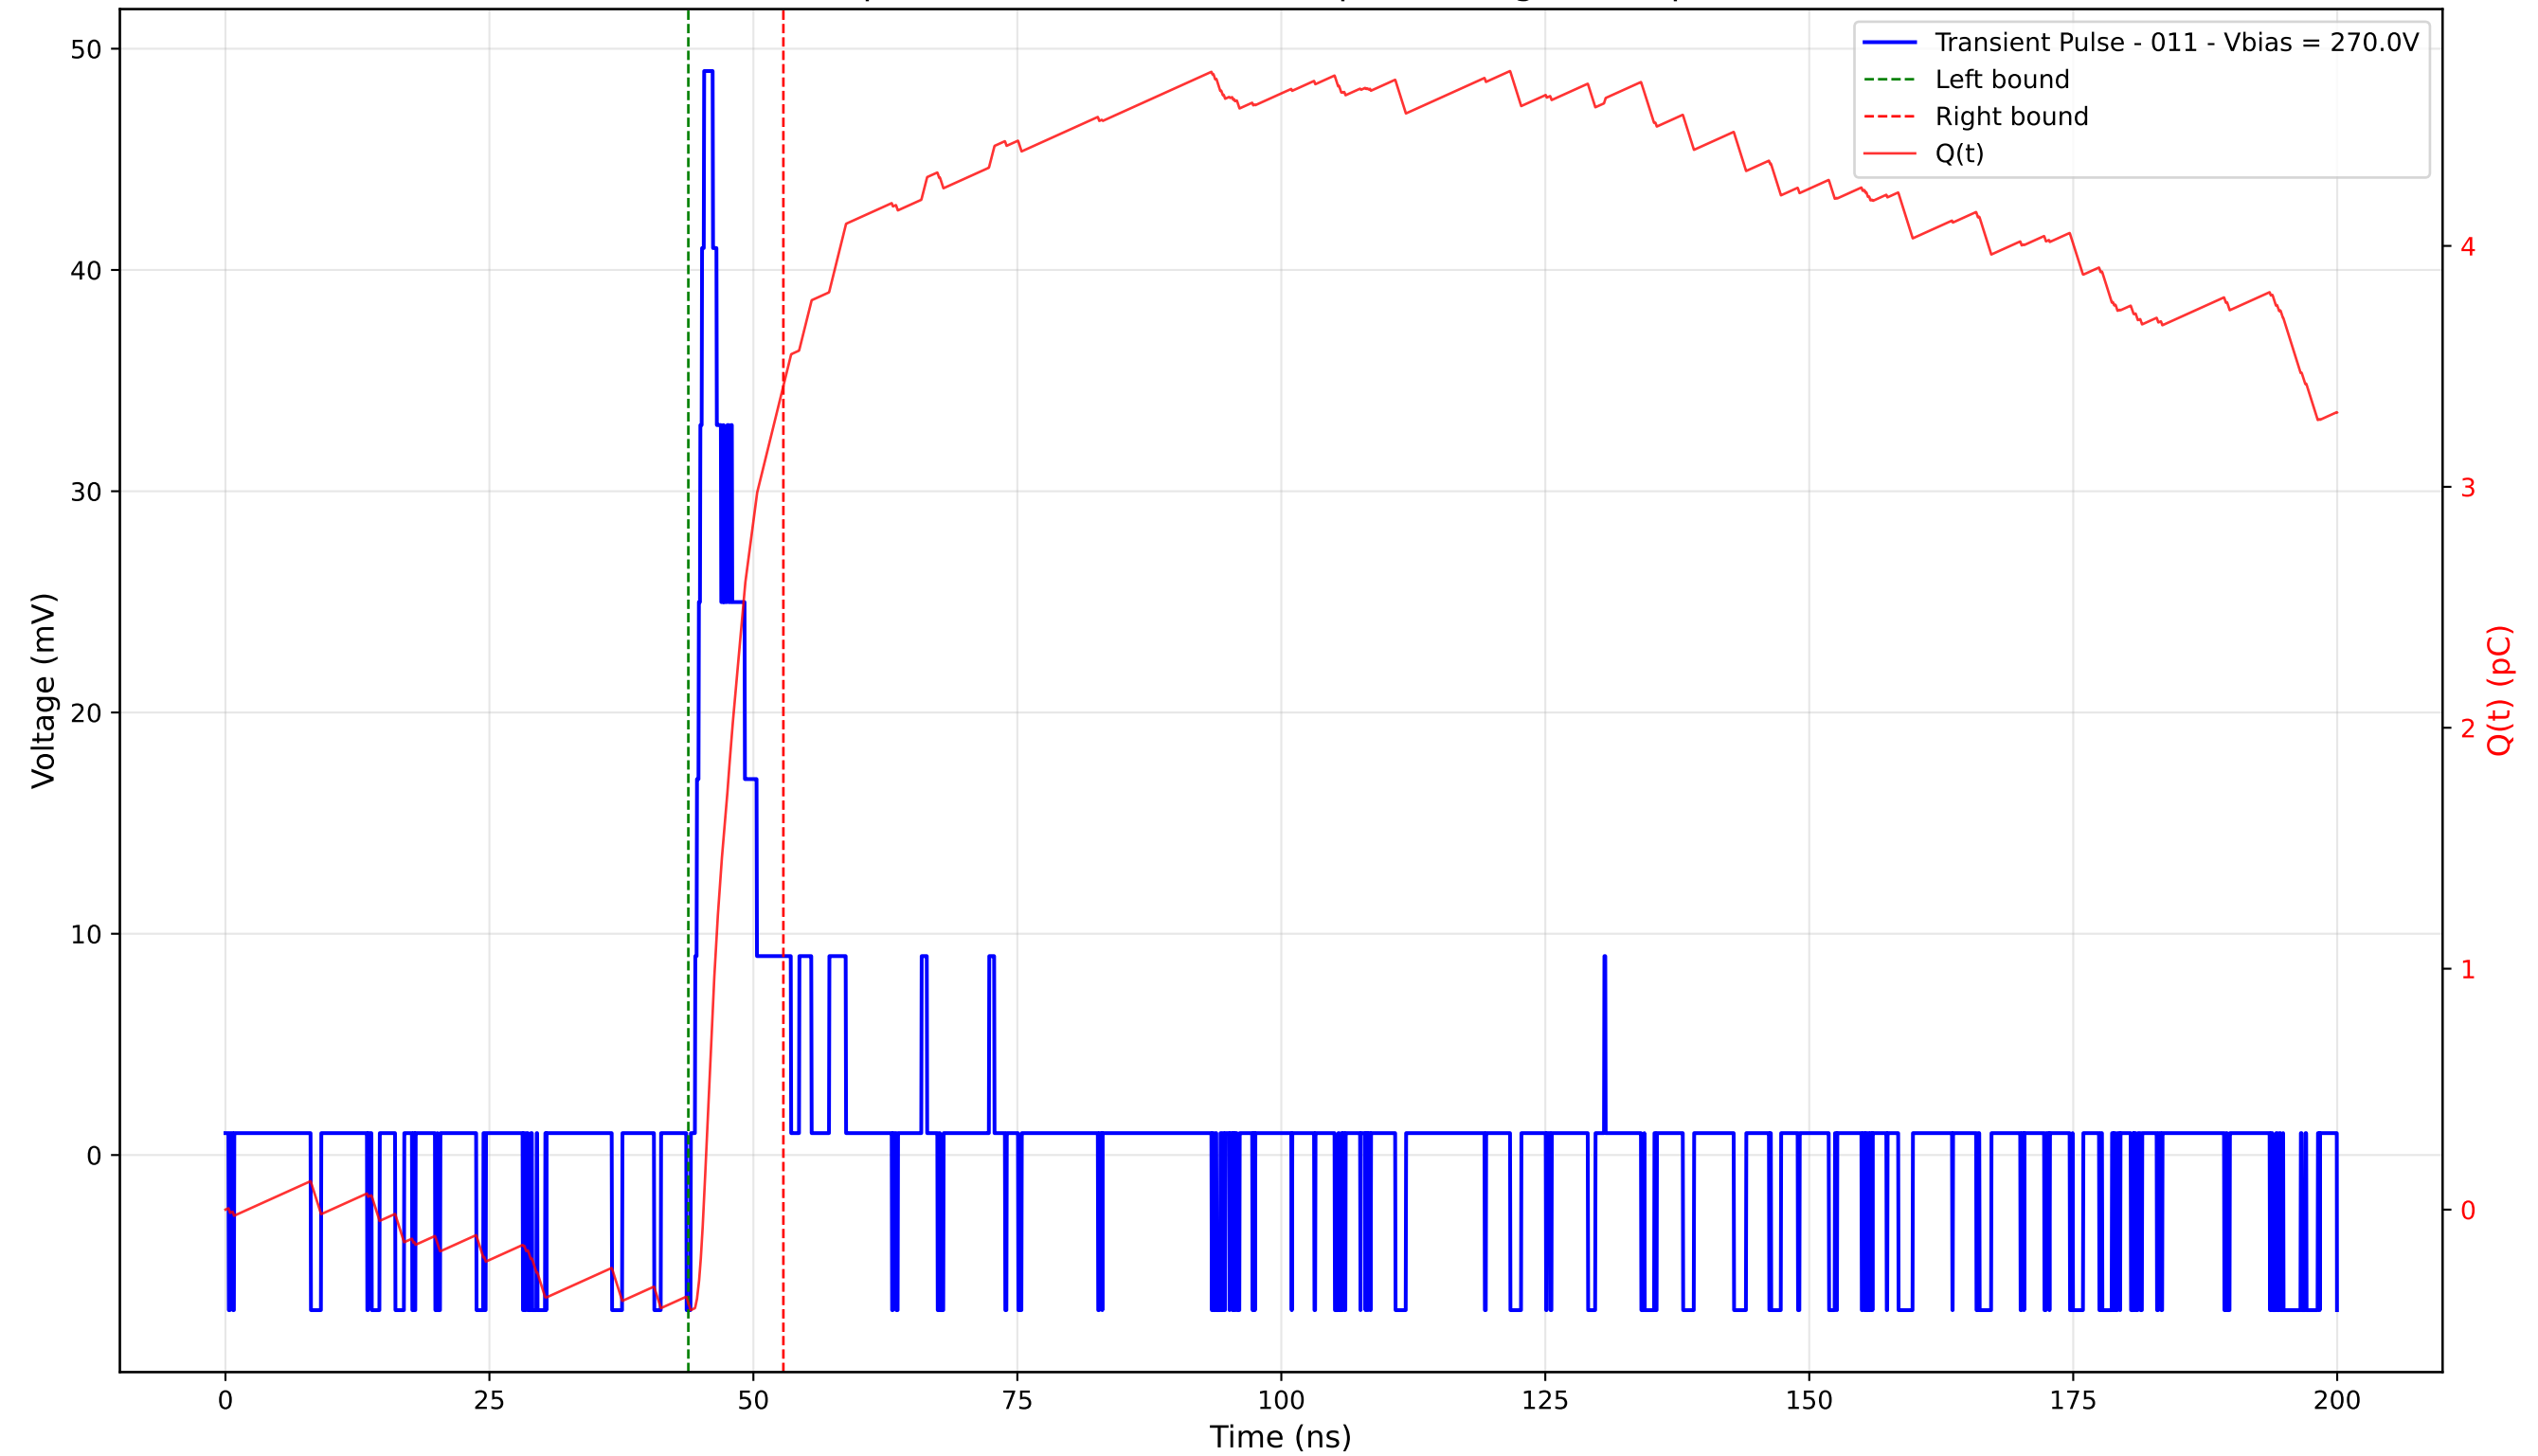

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.12 pC - Rise Time: 0.73 ns

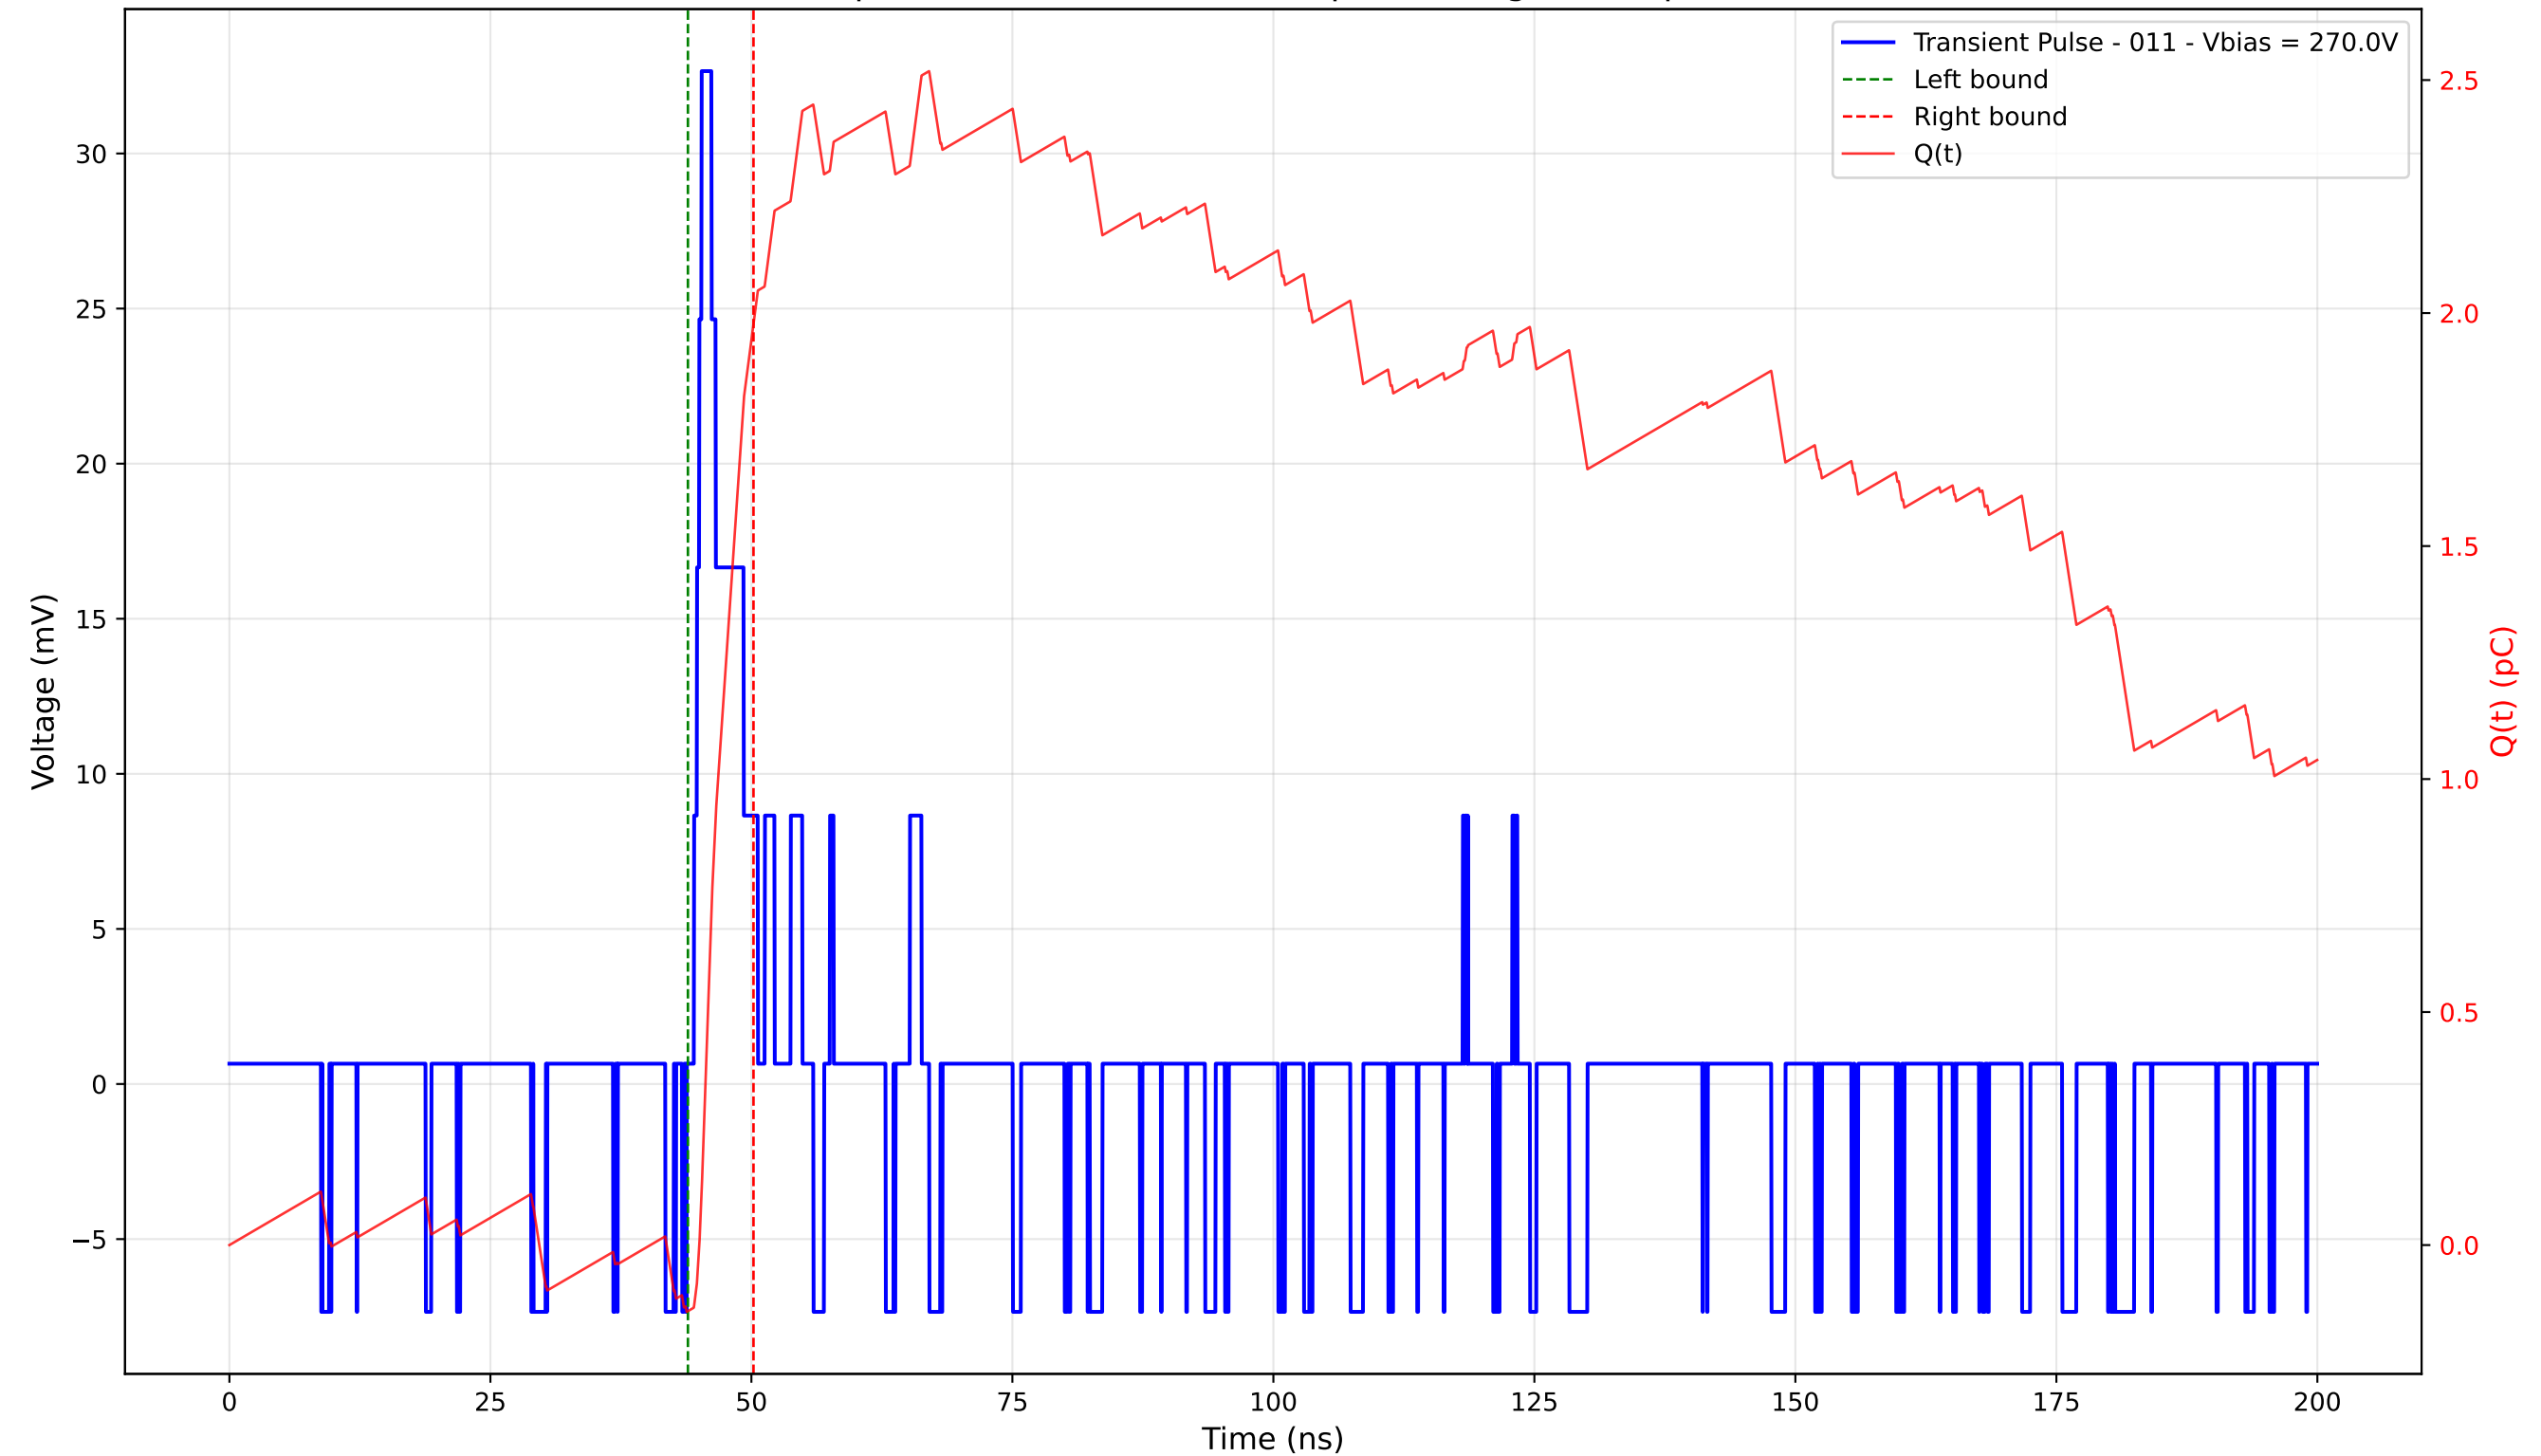

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 1.28 pC - Rise Time: 0.64 ns

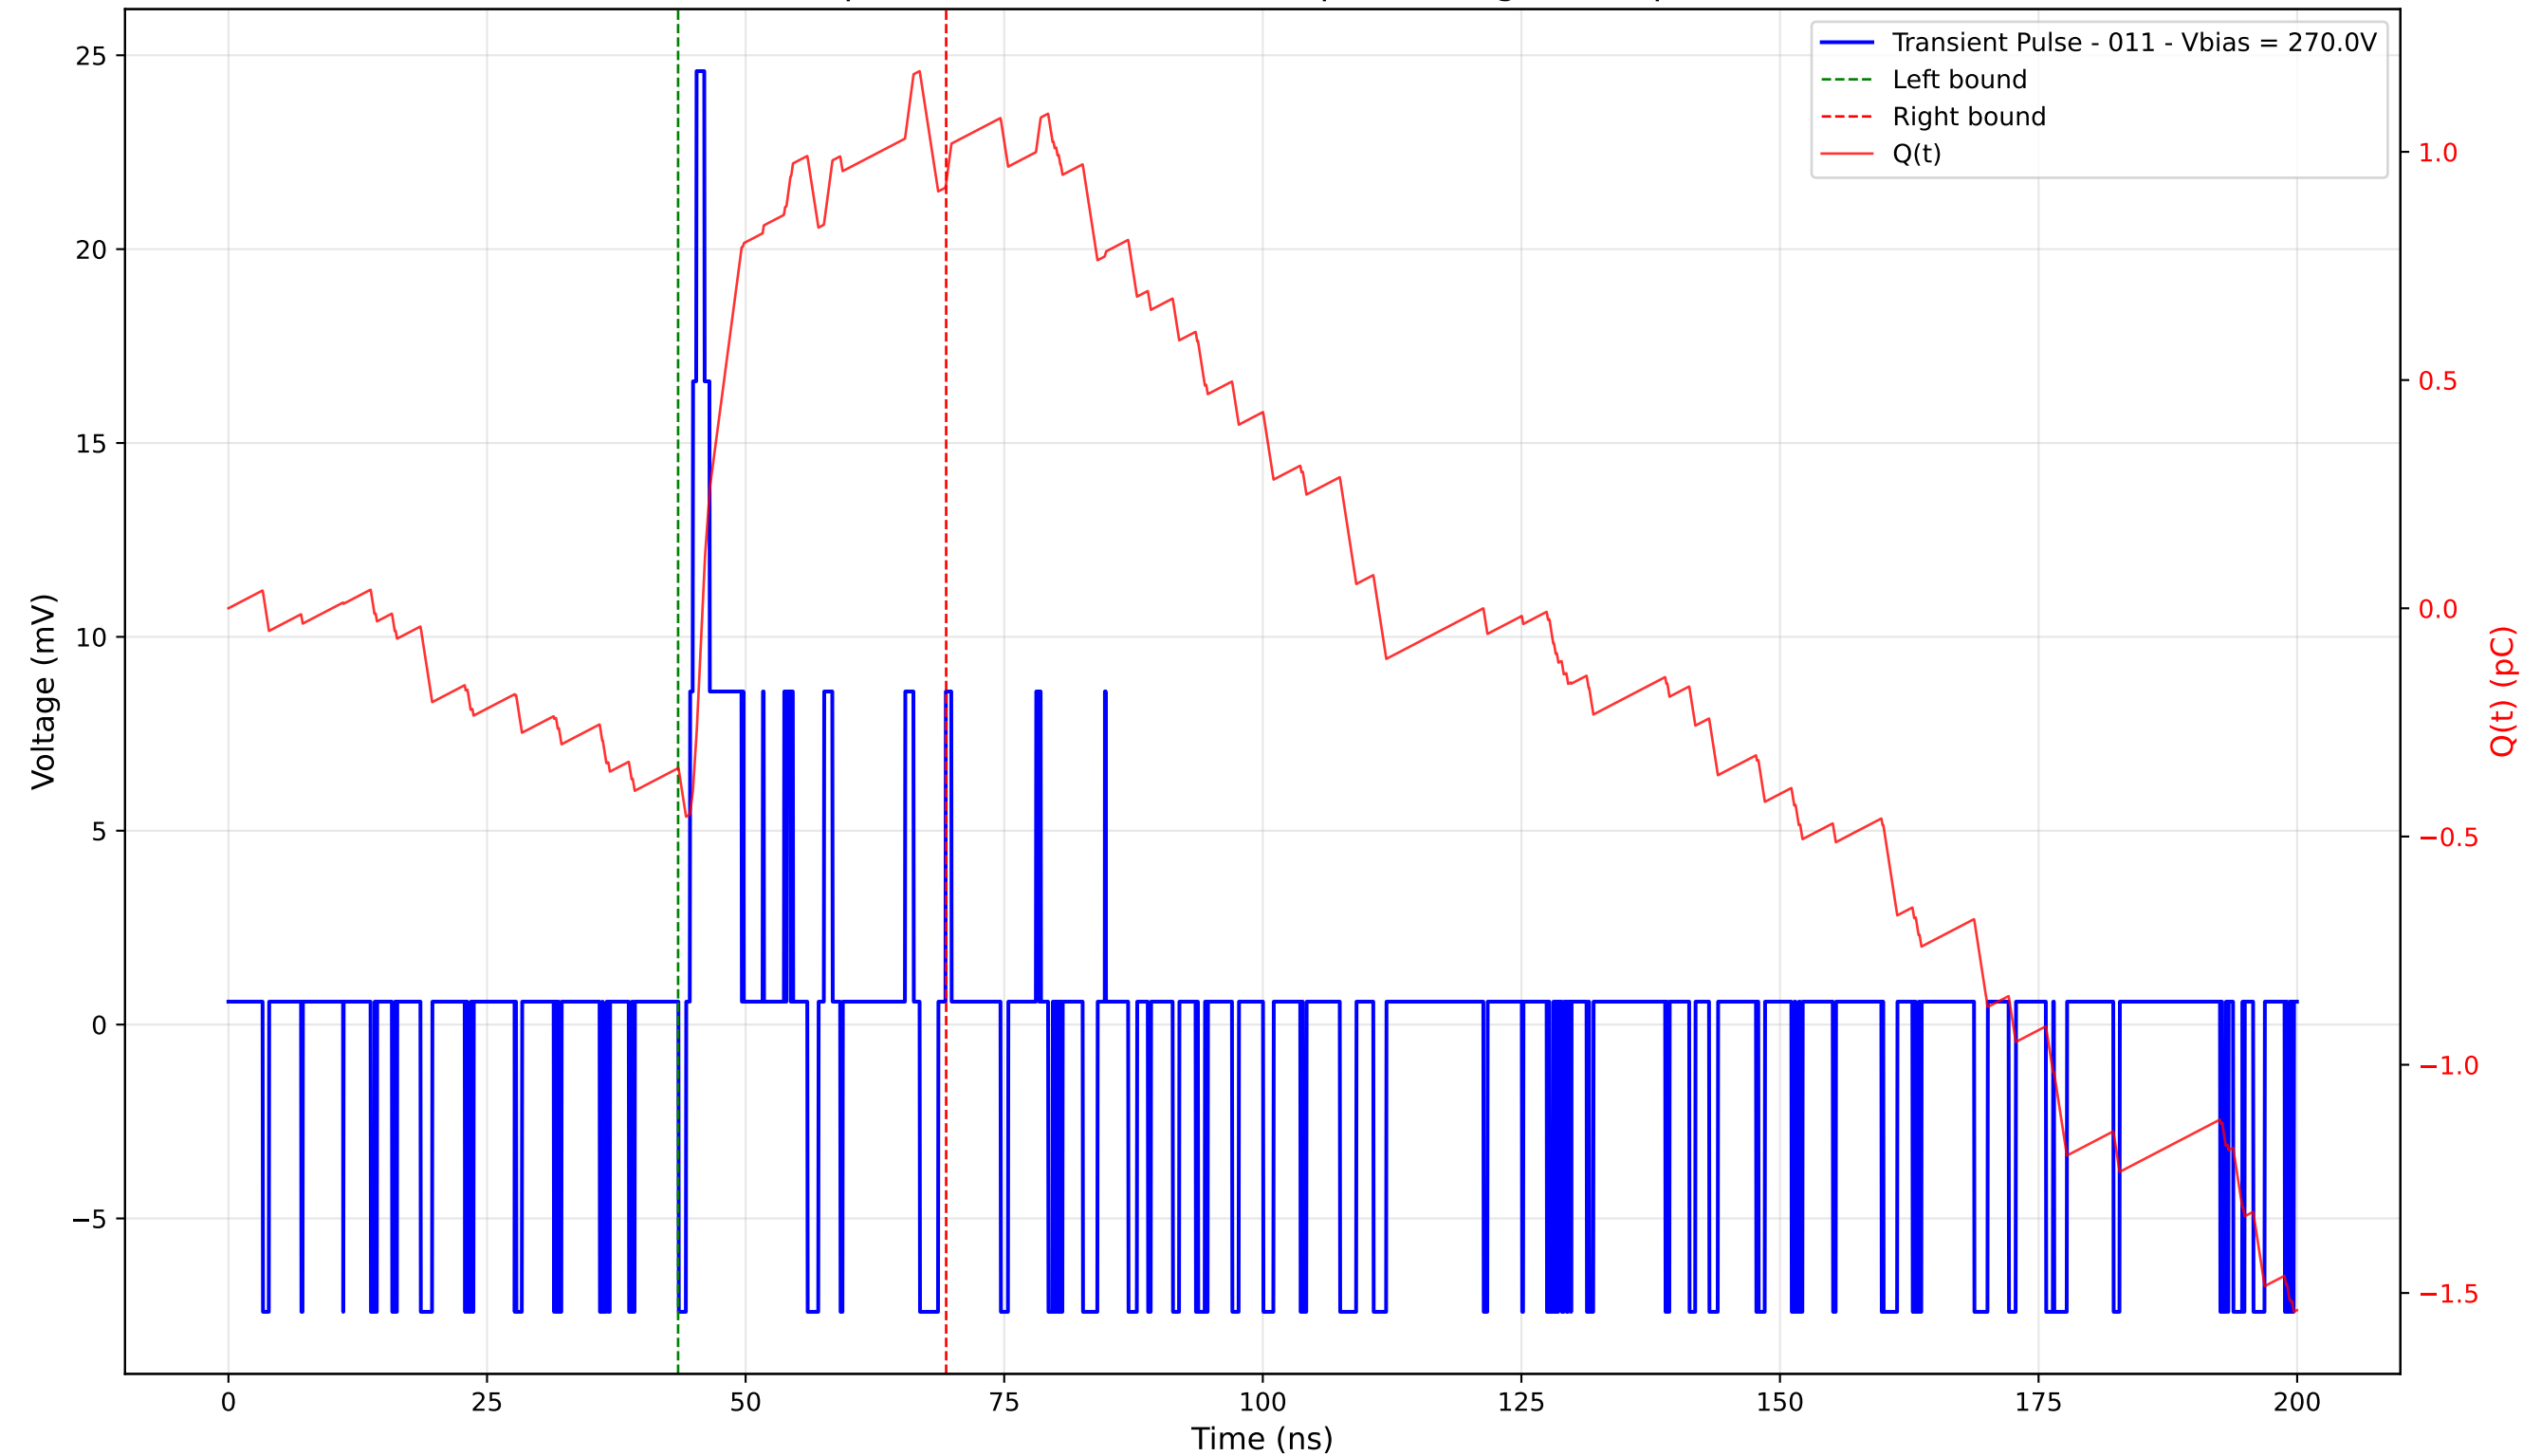

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 1.20 pC - Rise Time: 0.58 ns

