


TCT Run 015 Summary

Parameter	Value
Run	Run015
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	190.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\190V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

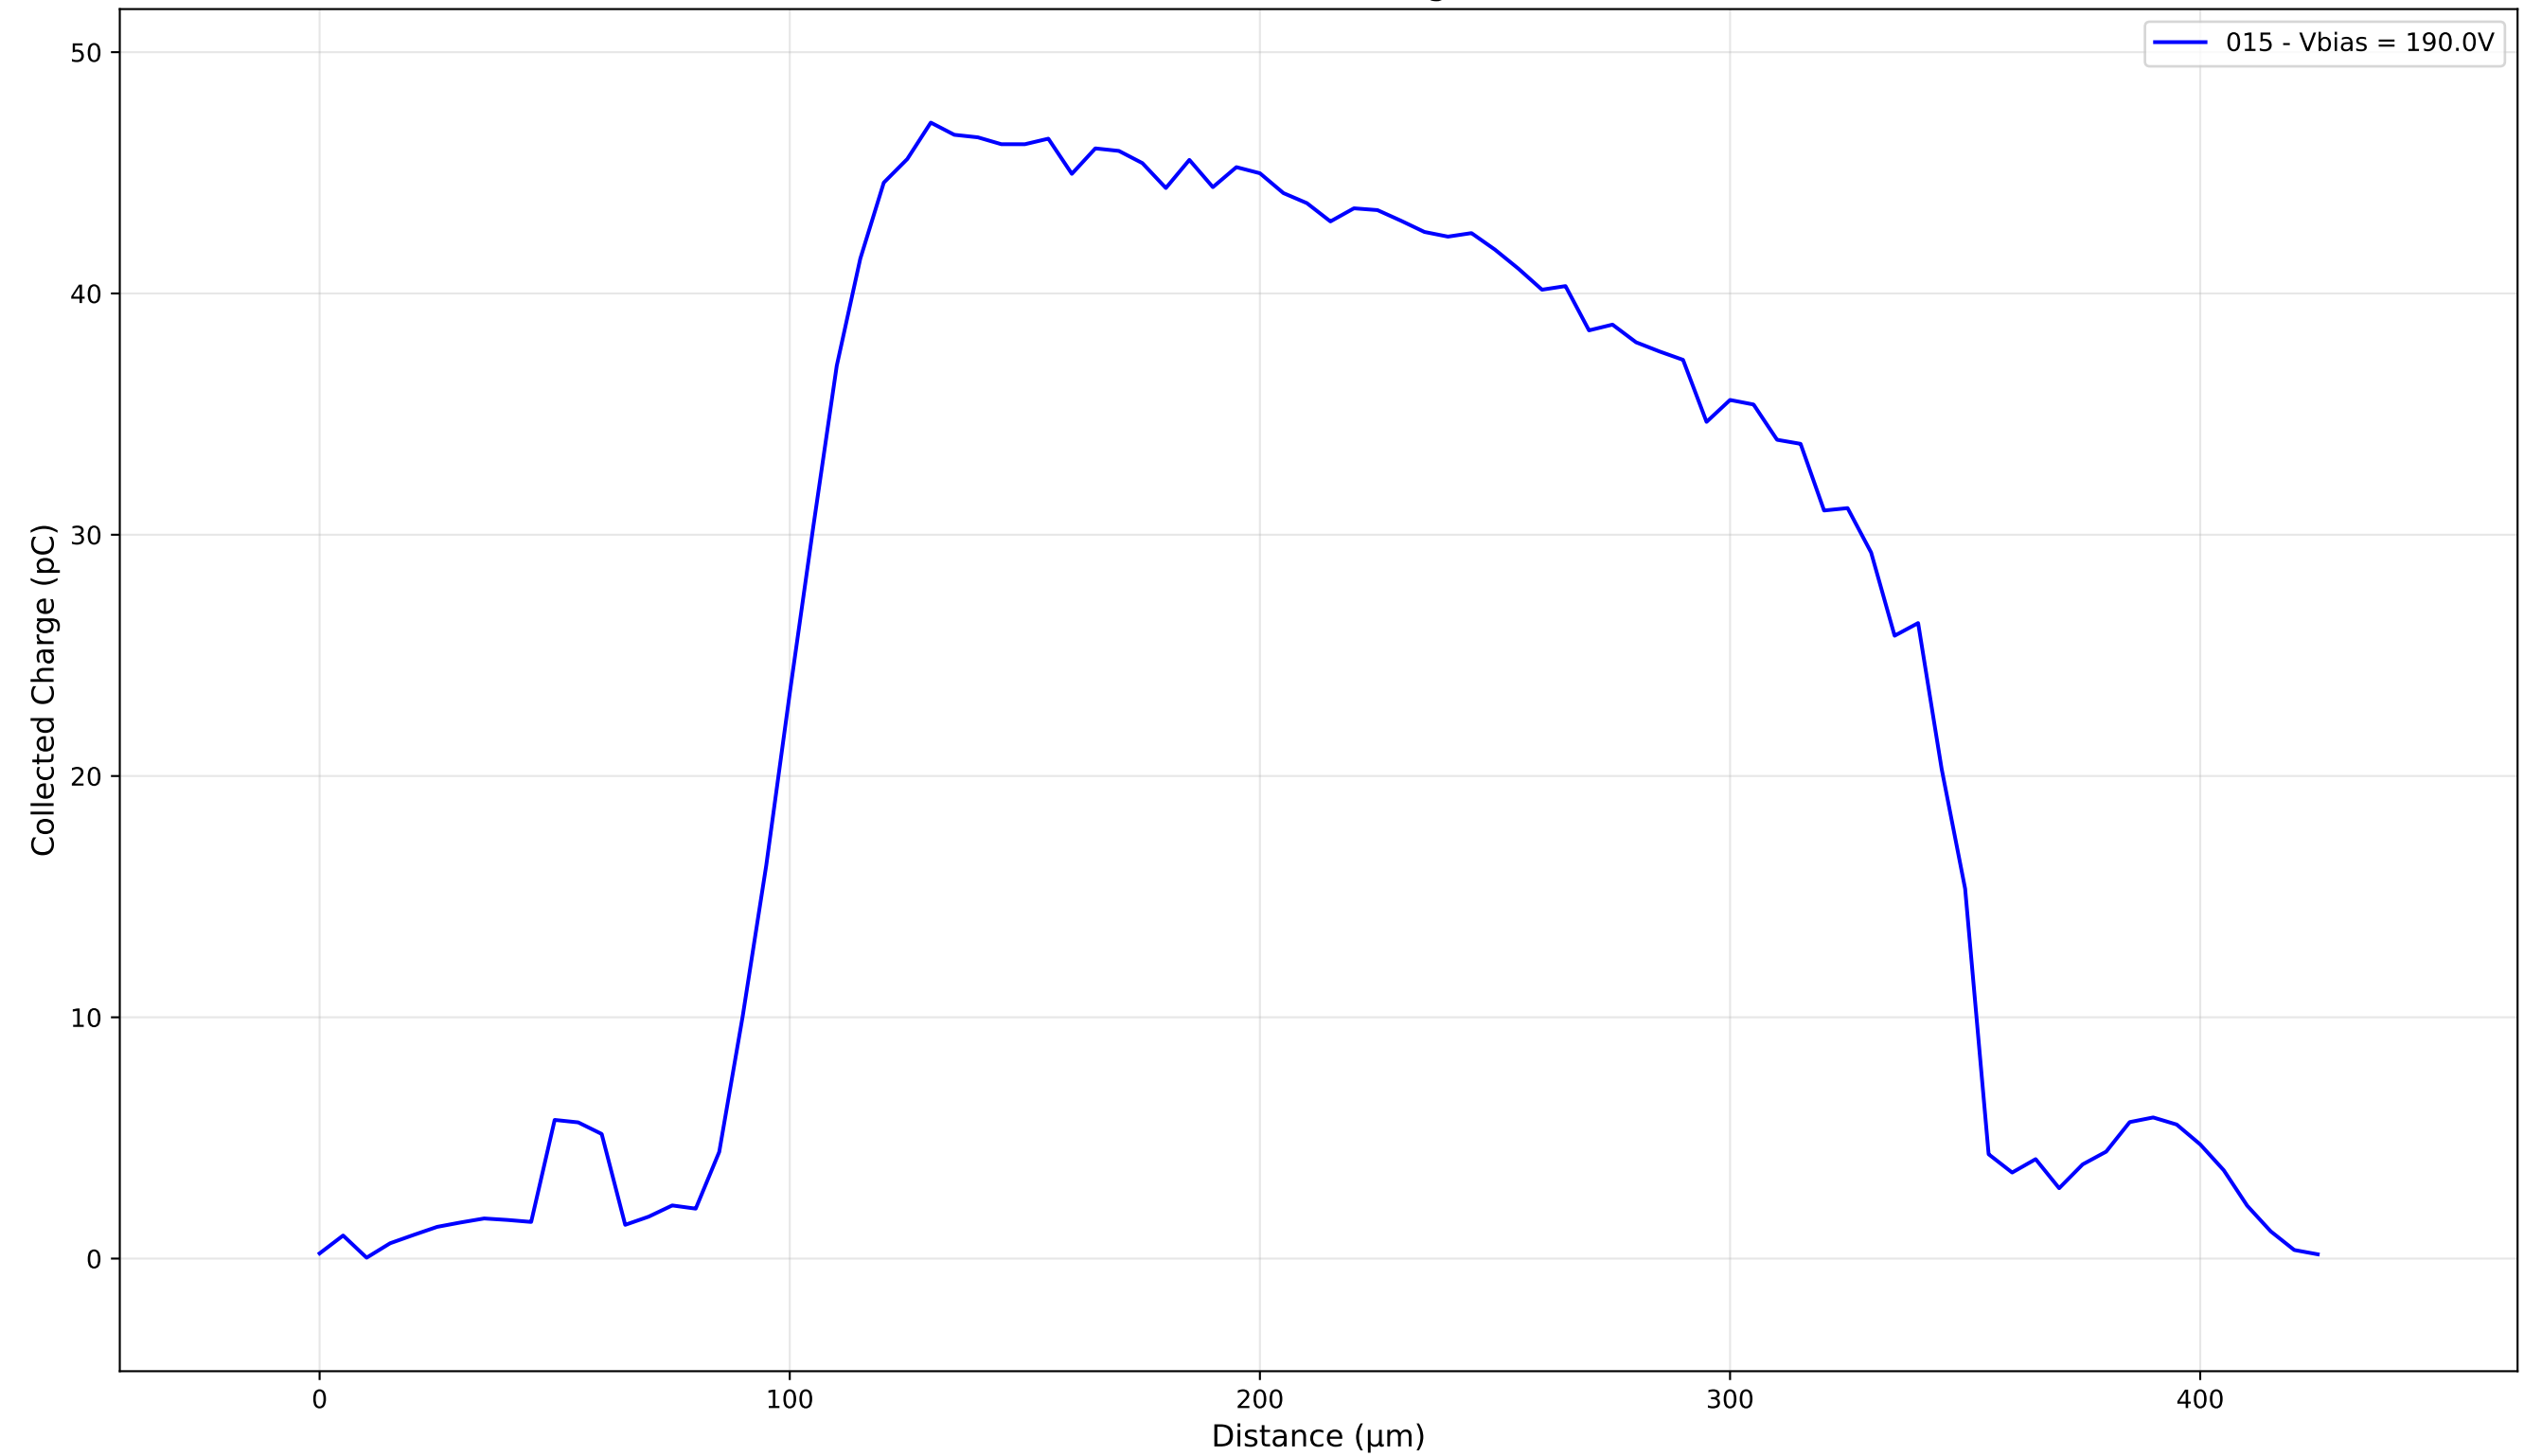

Collected Charge

015 - Vbias = 190.0V

Collected Charge [a.u.]

1.0

0.8

0.6

0.4

0.2

0.0

0


100

200


300

400


Distance (μm)

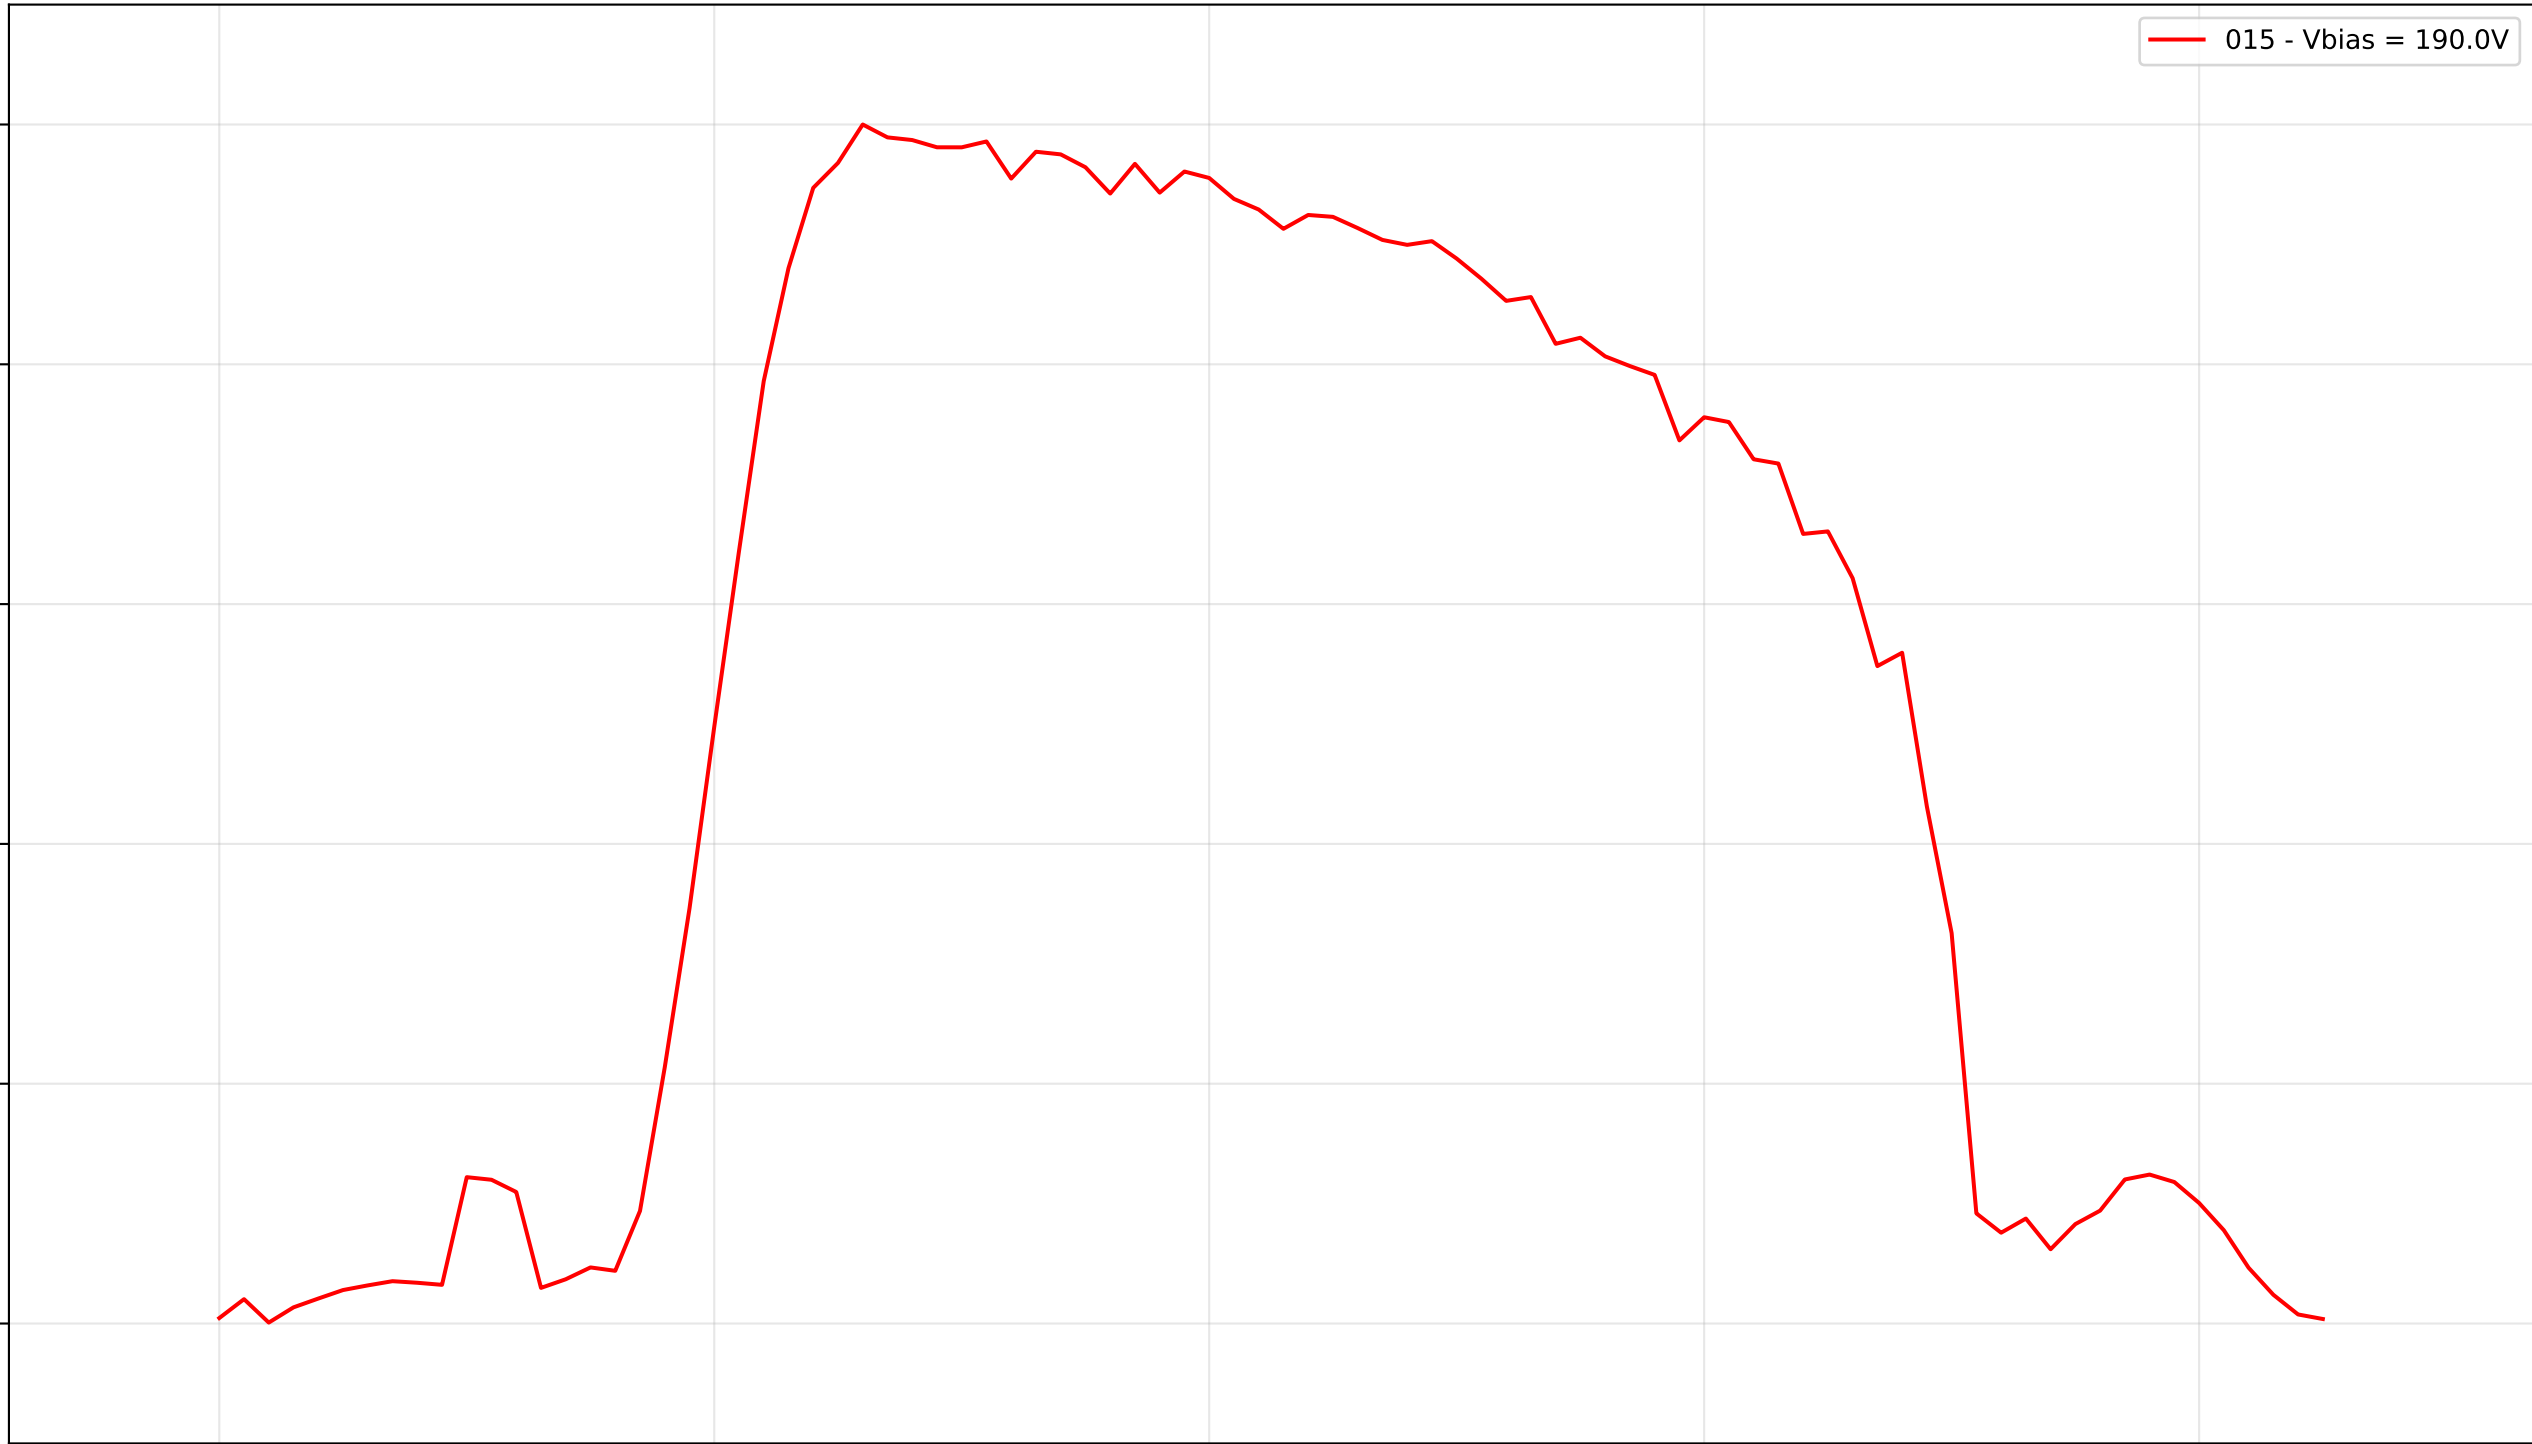


Rise Time

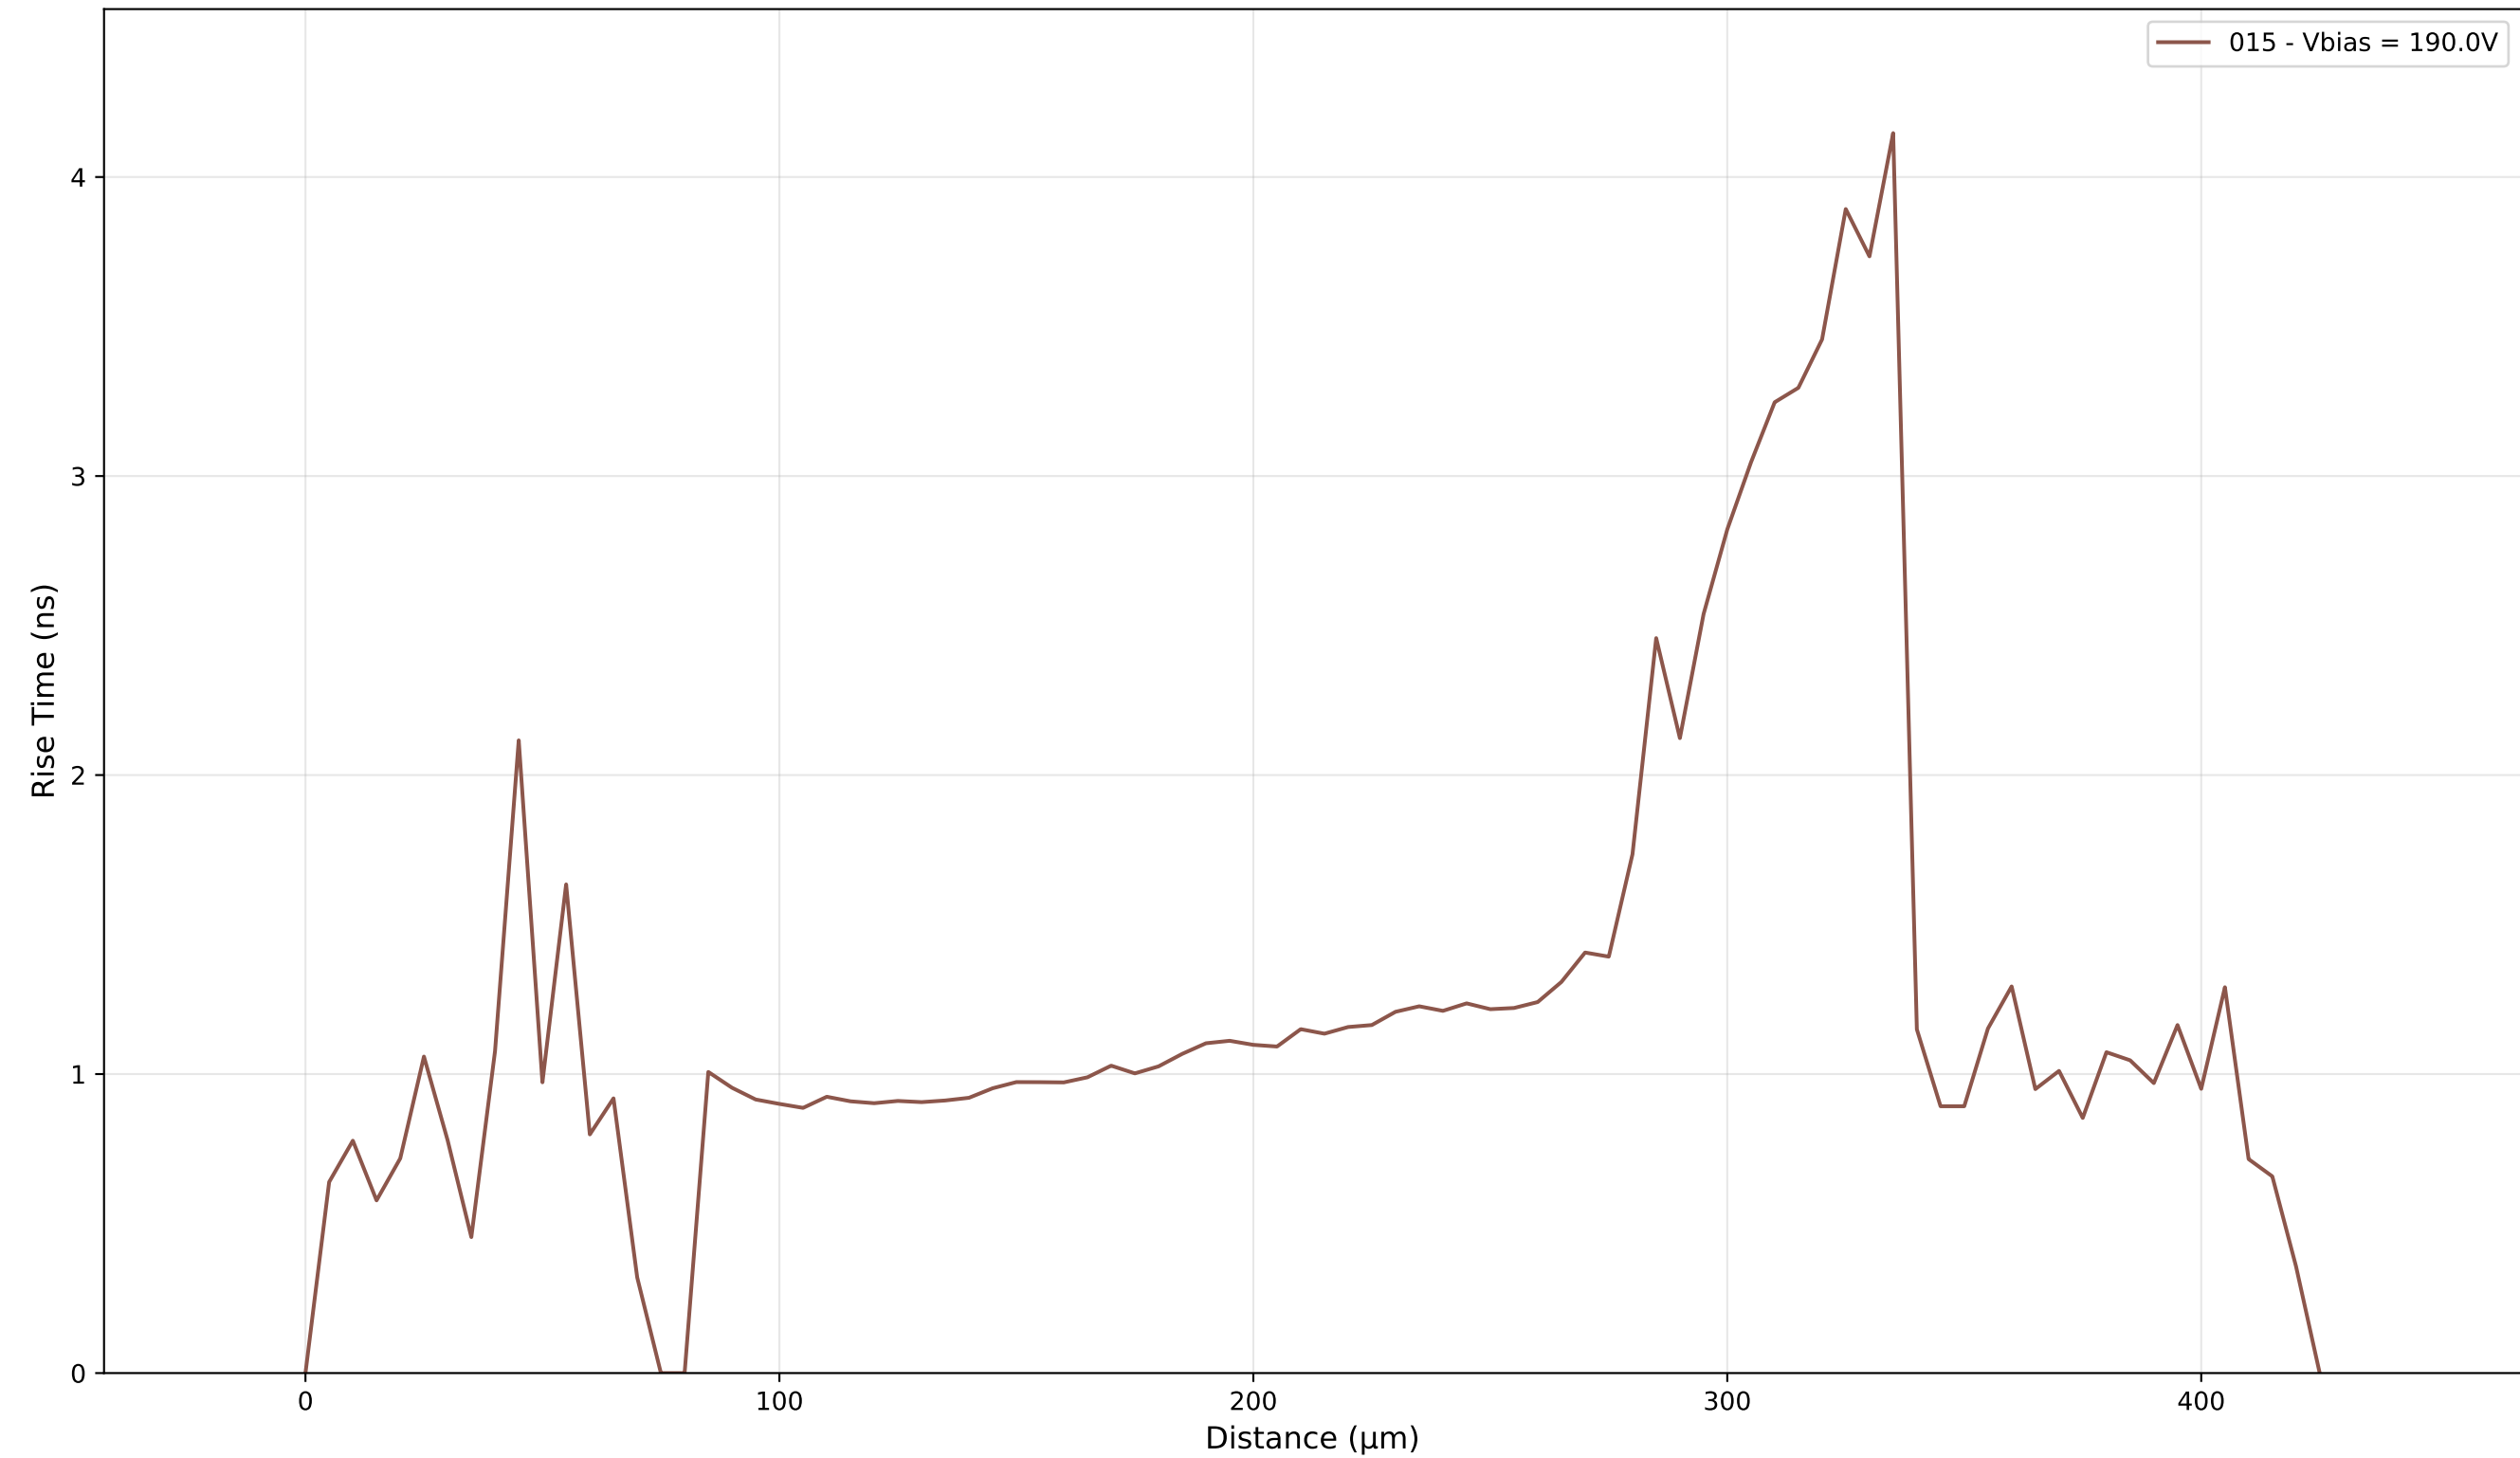


Amplitude

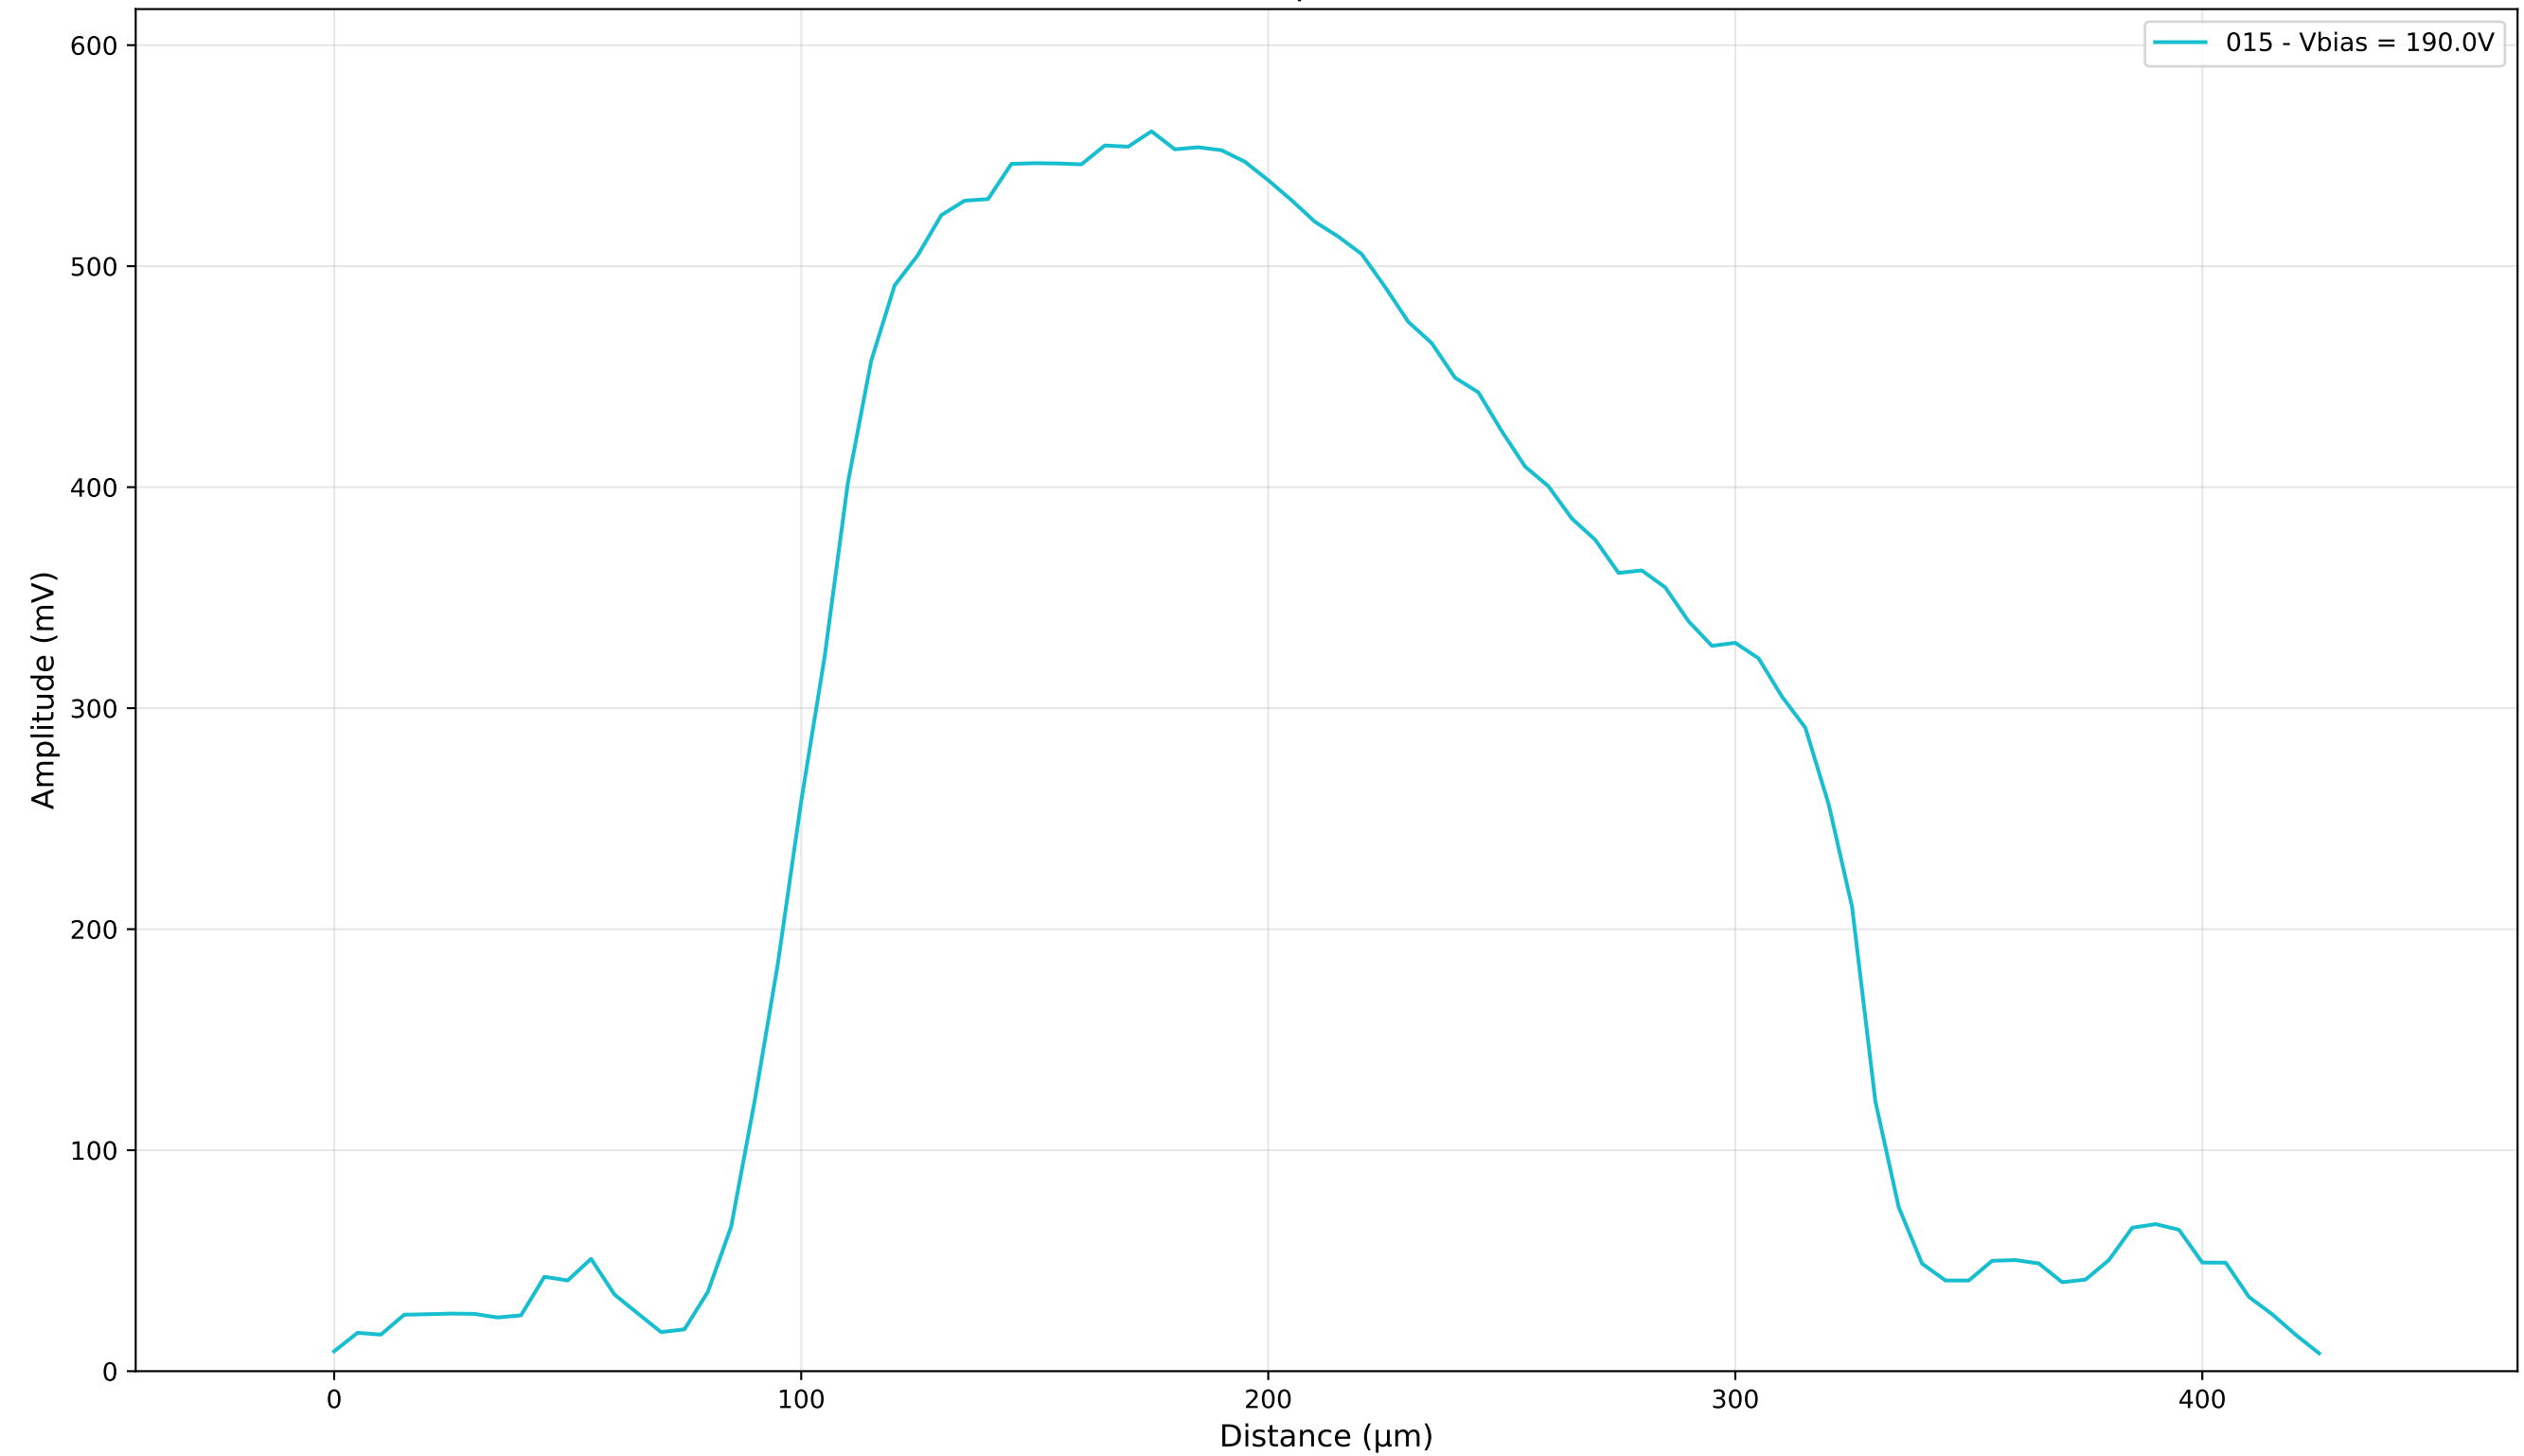


FWHM

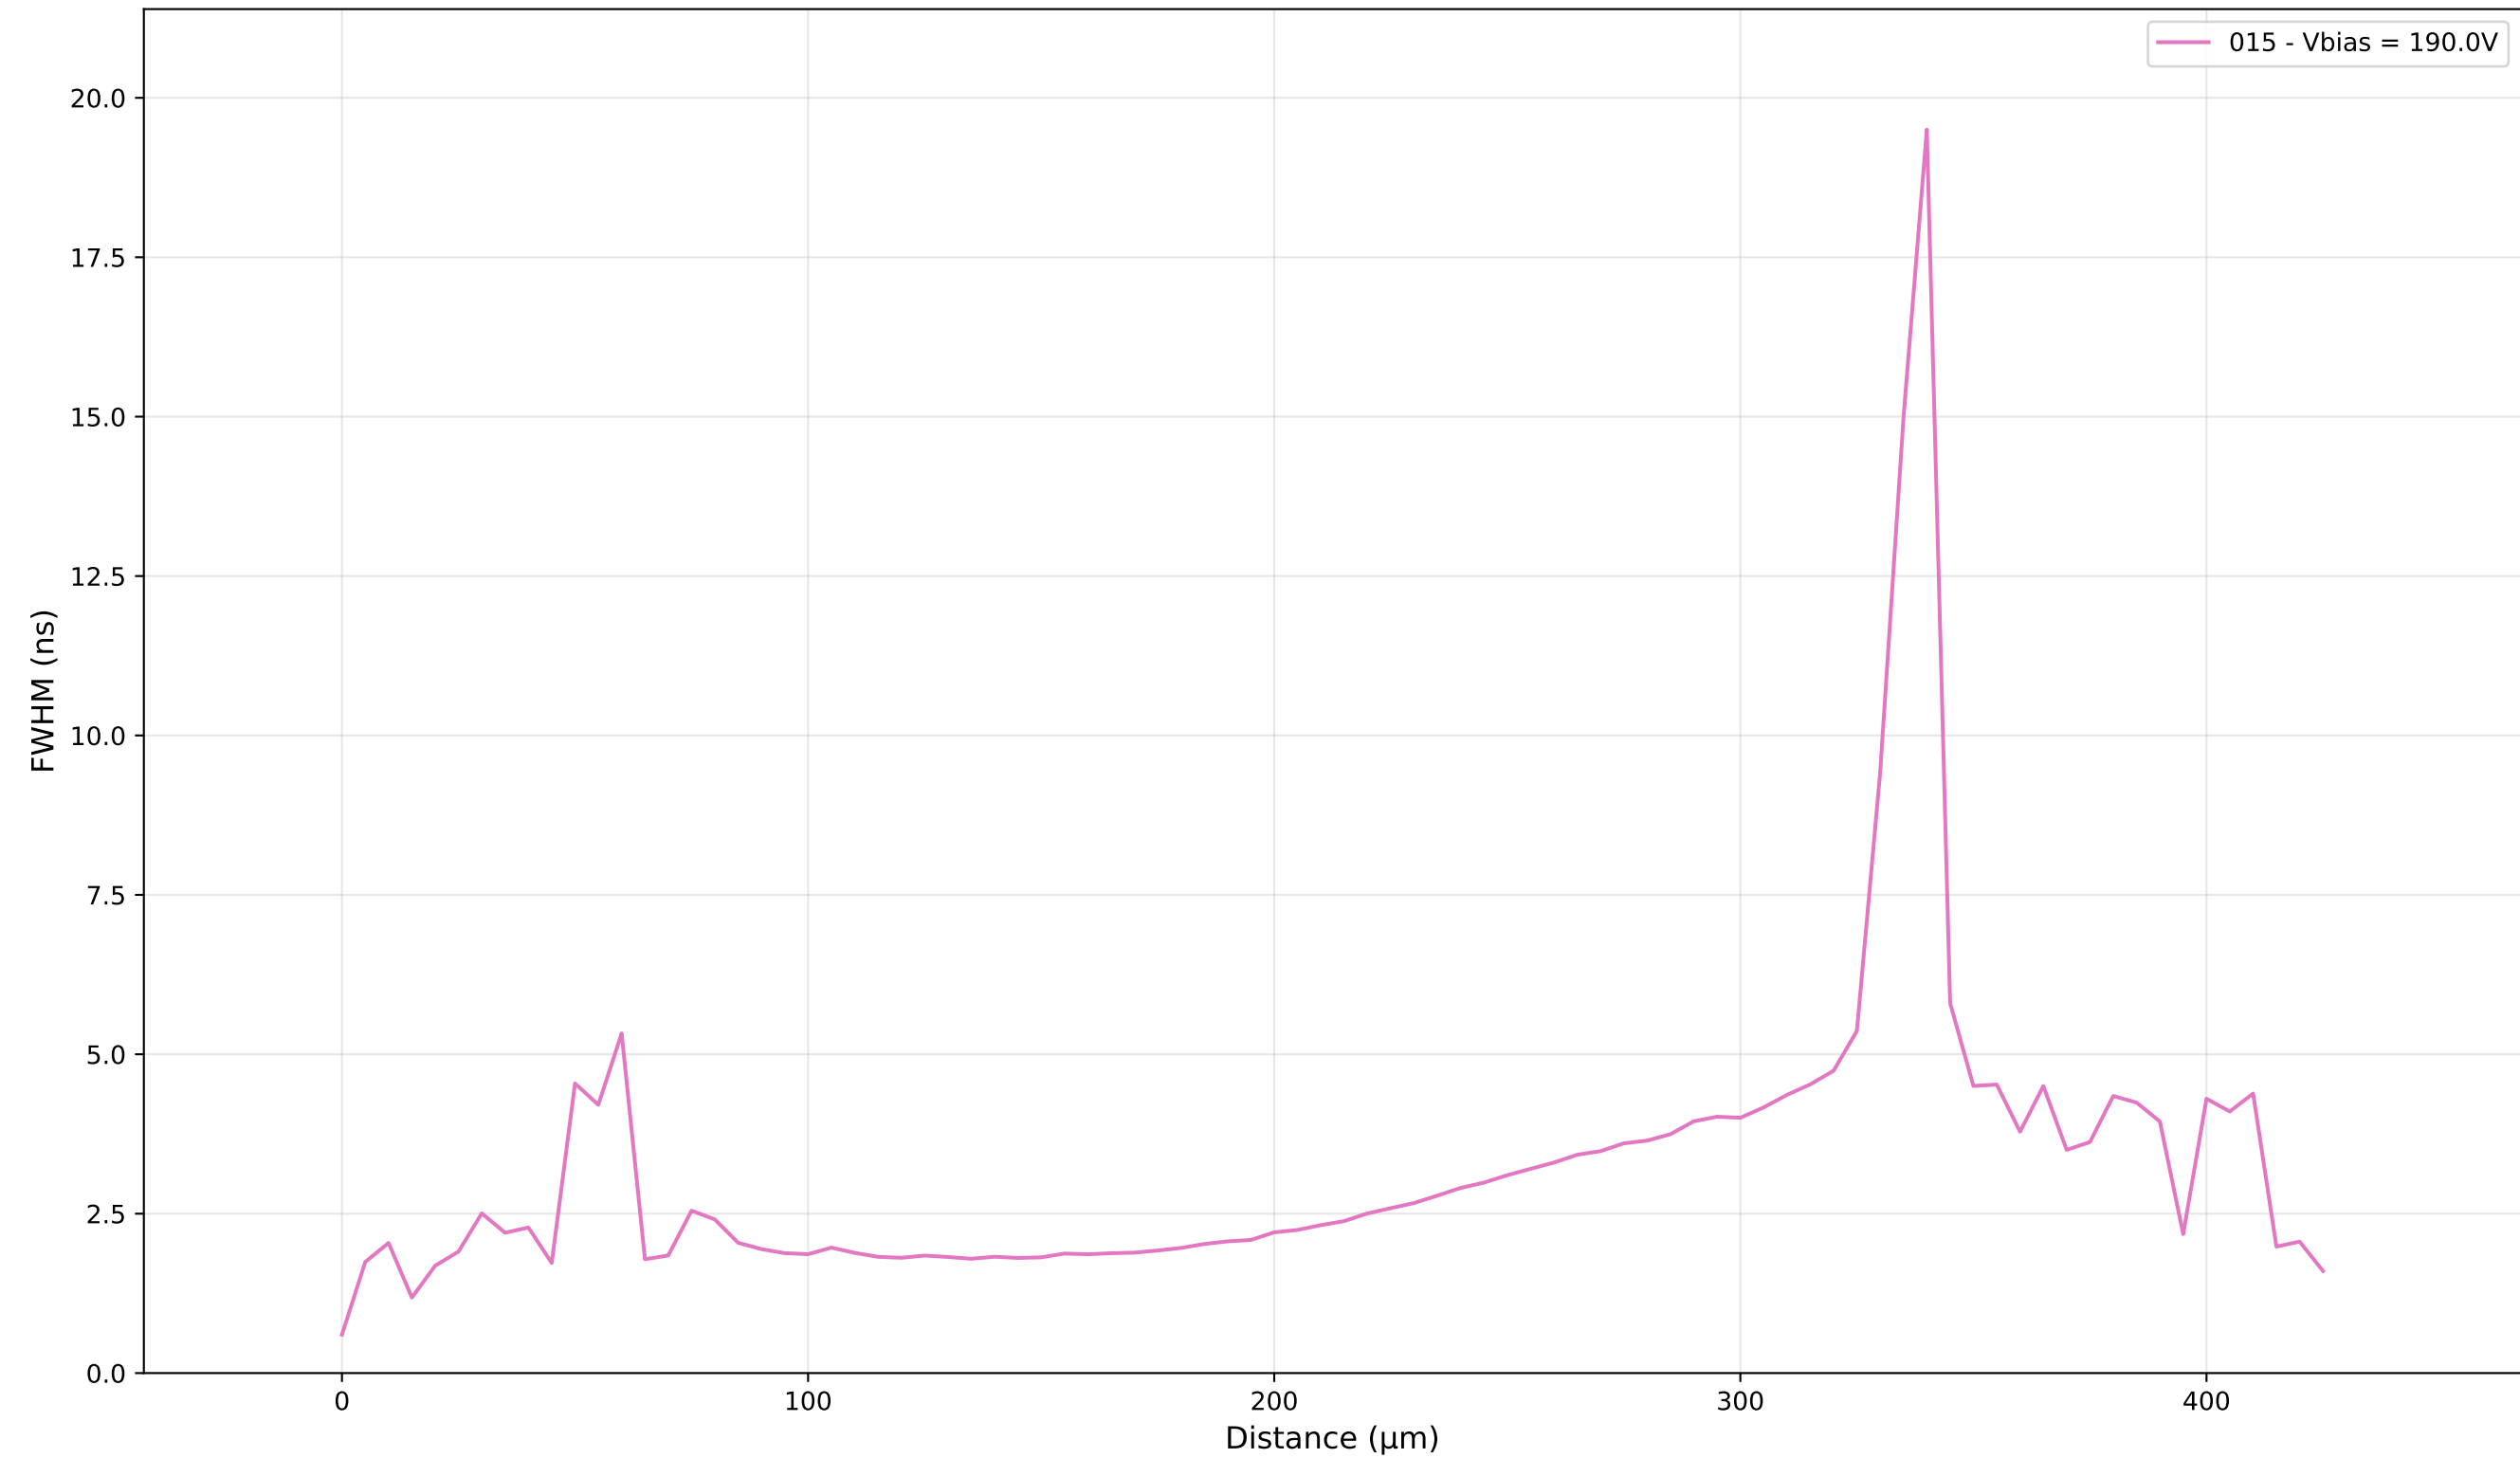


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.21 pC - Rise Time: 0.00 ns (N/A)

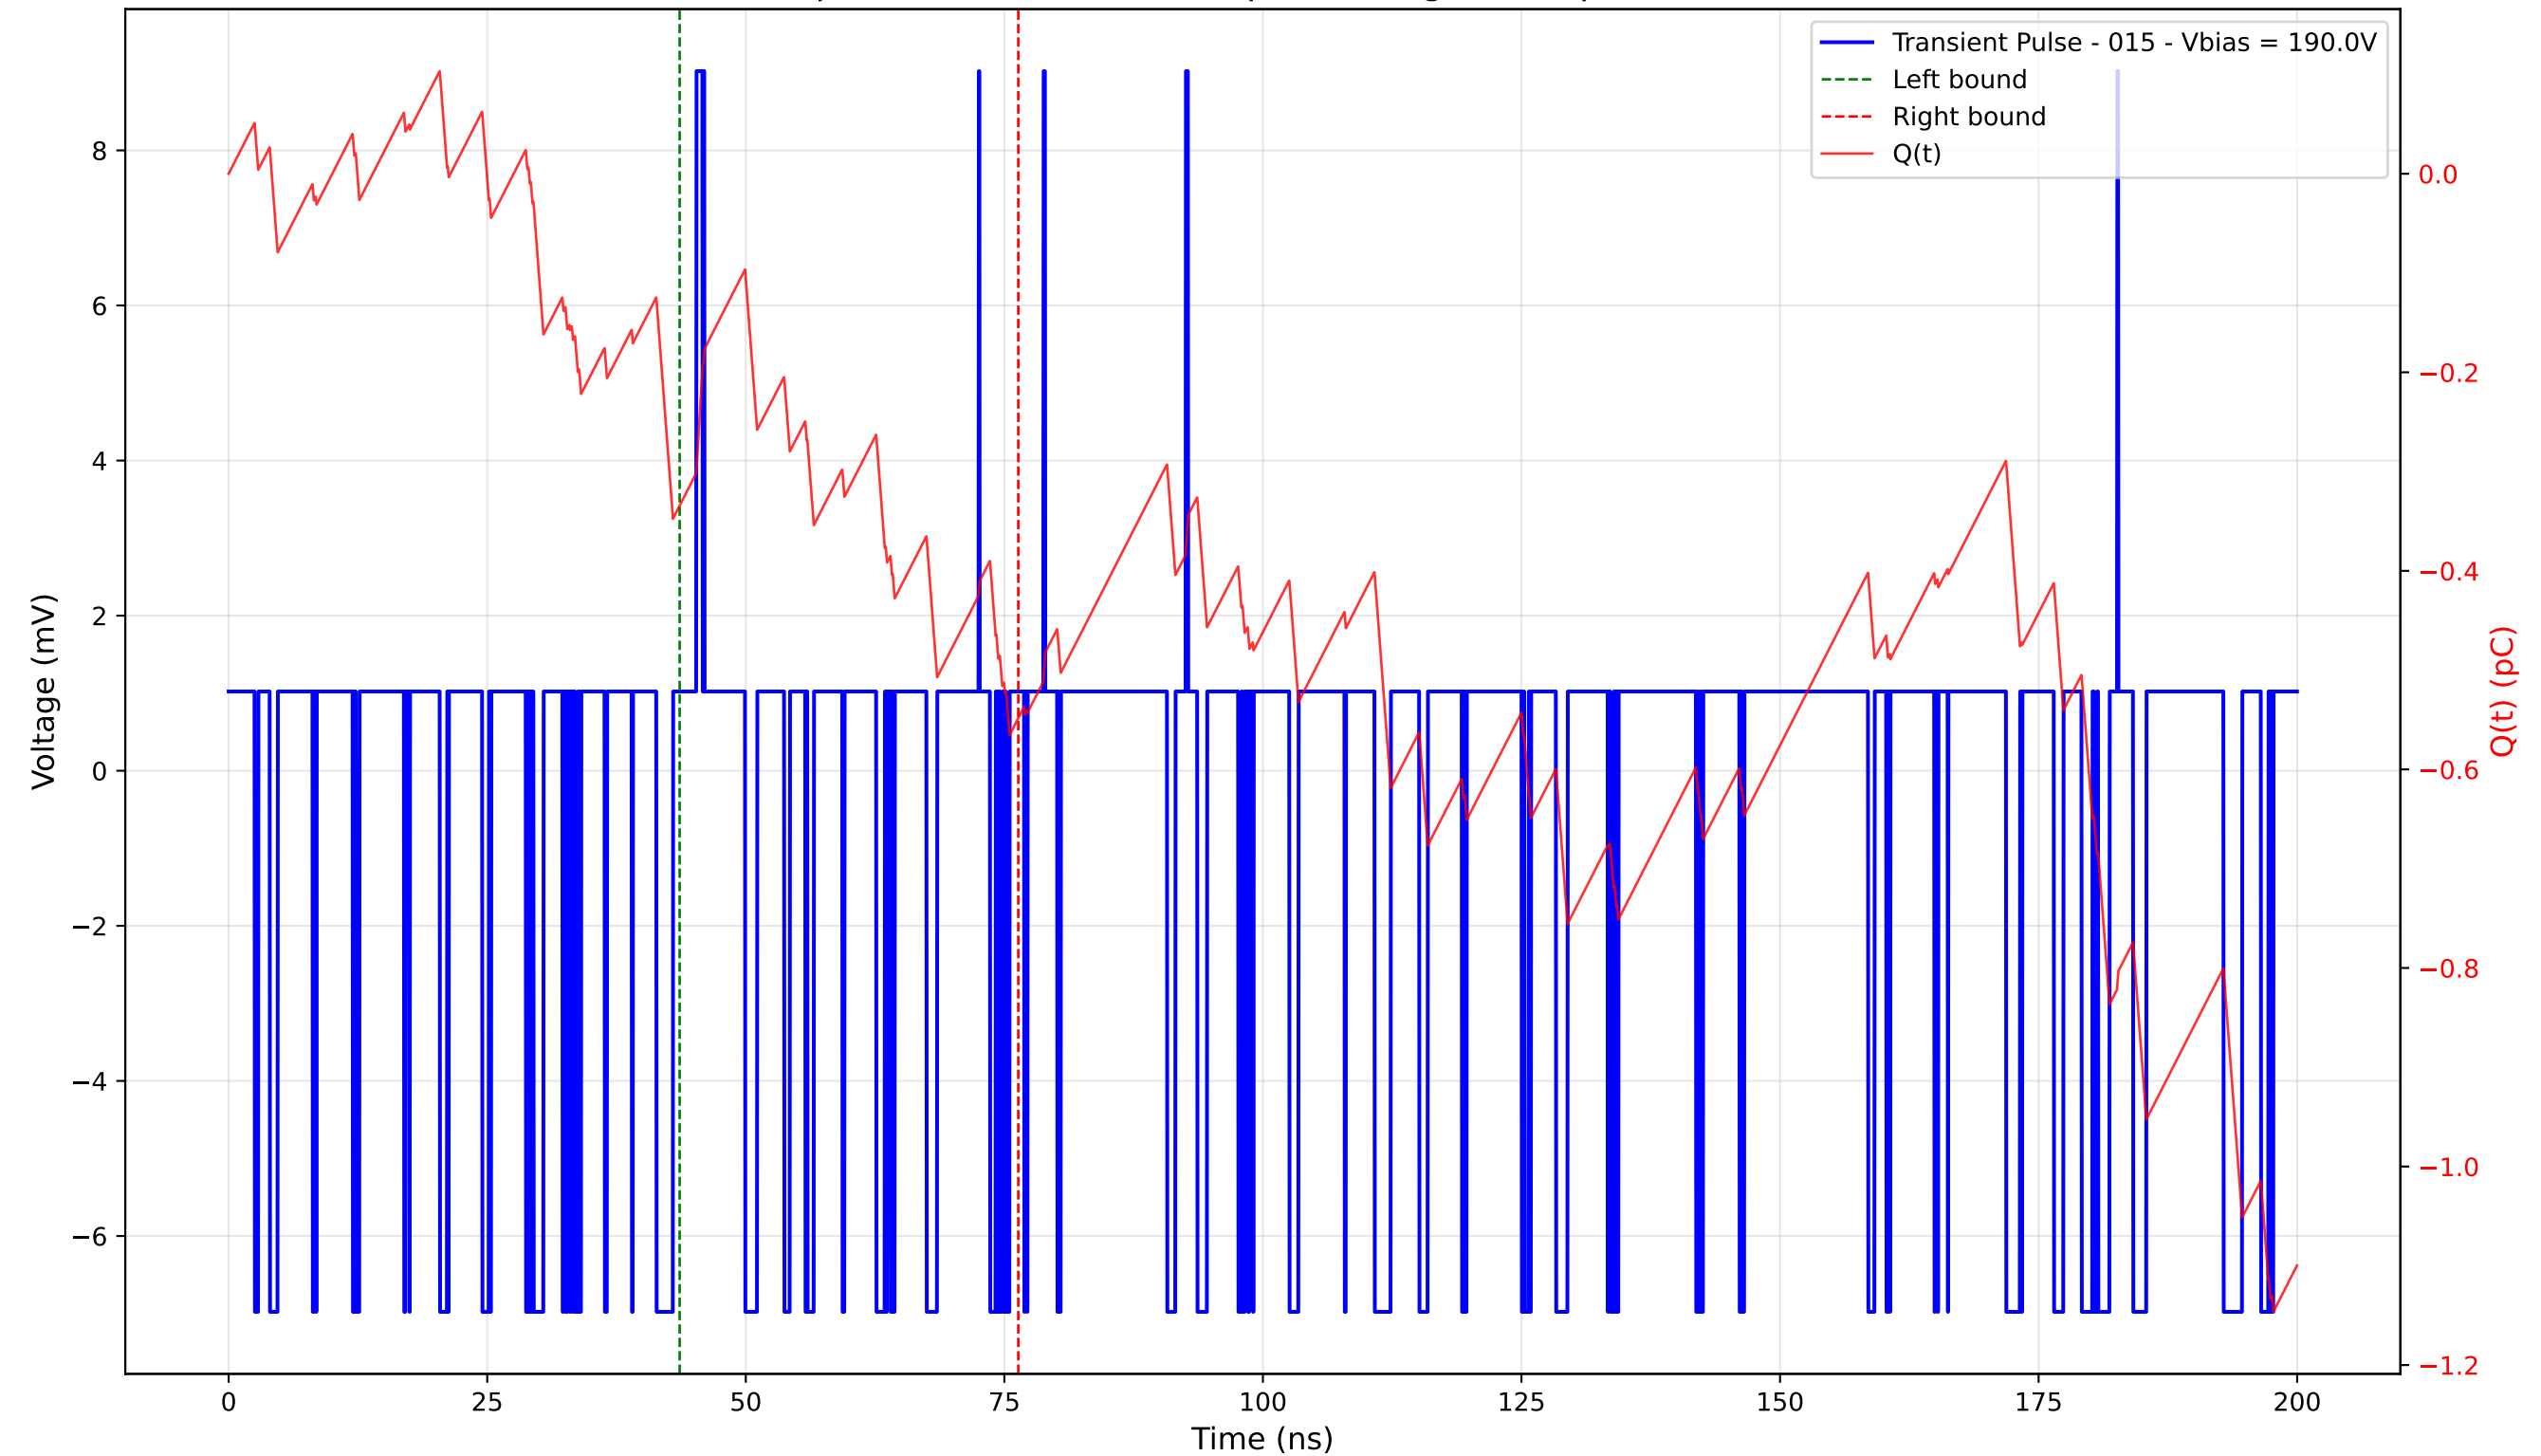


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.96 pC - Rise Time: 0.64 ns

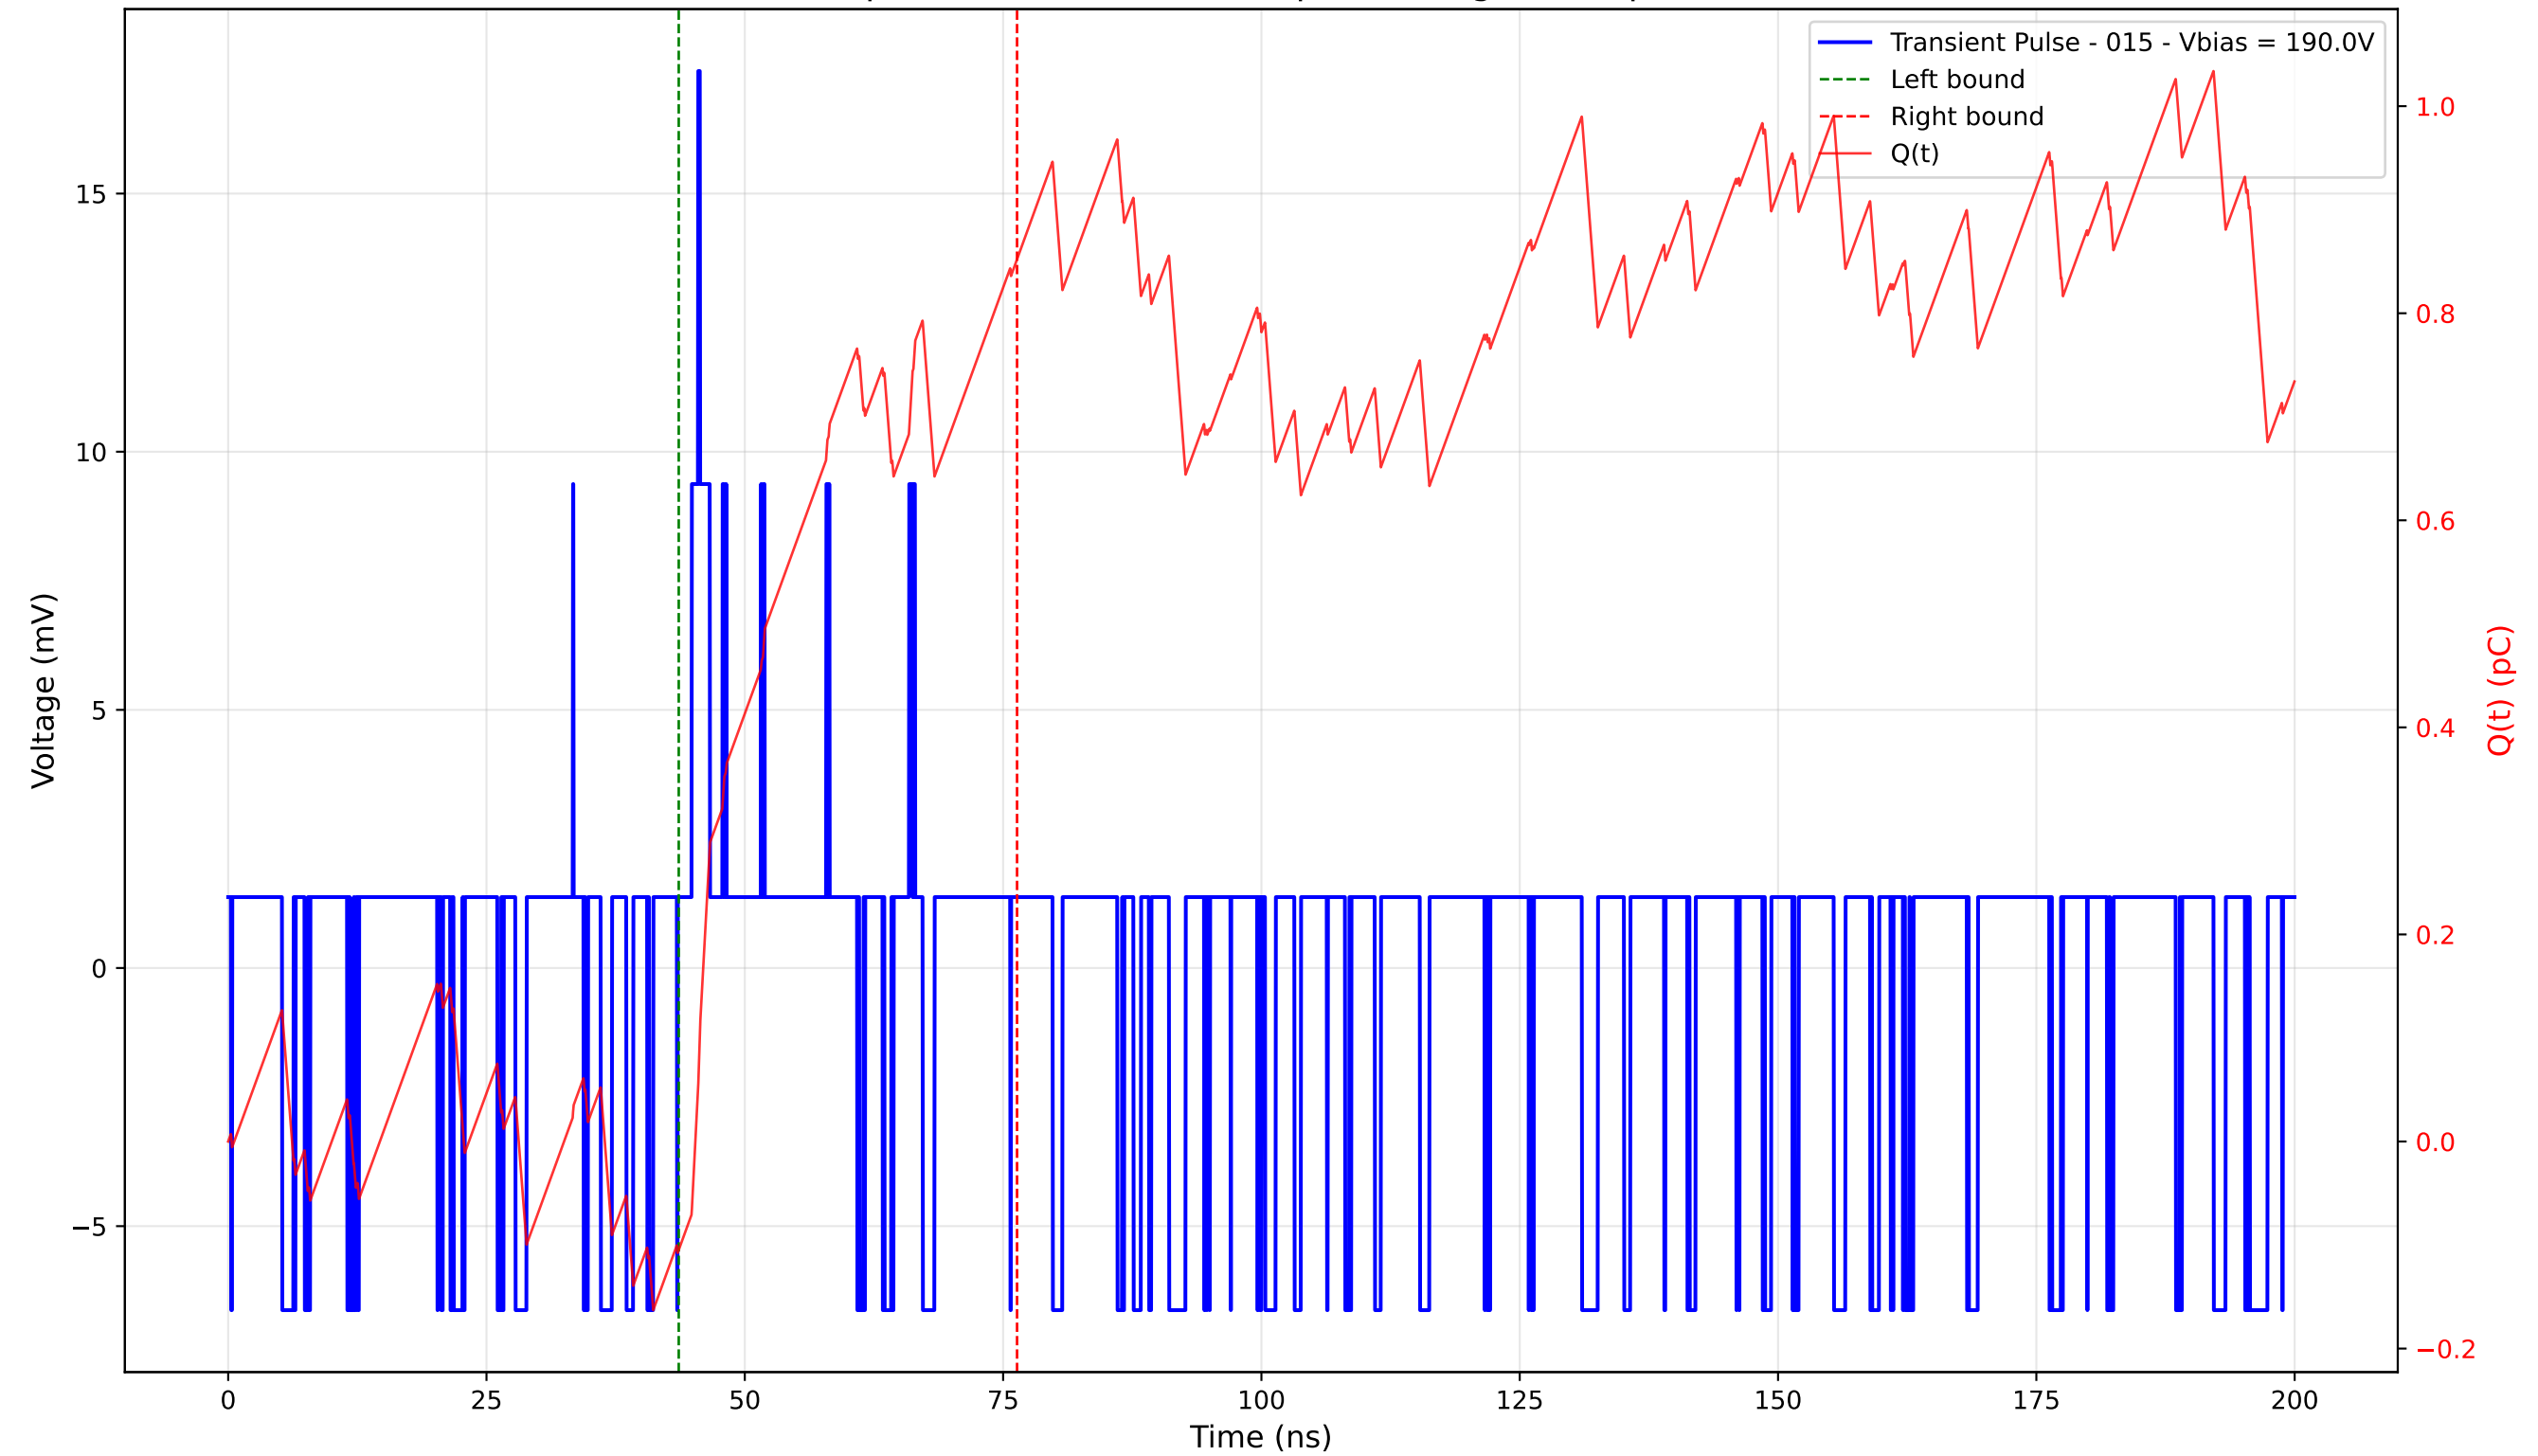


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 0.04 pC - Rise Time: 0.78 ns

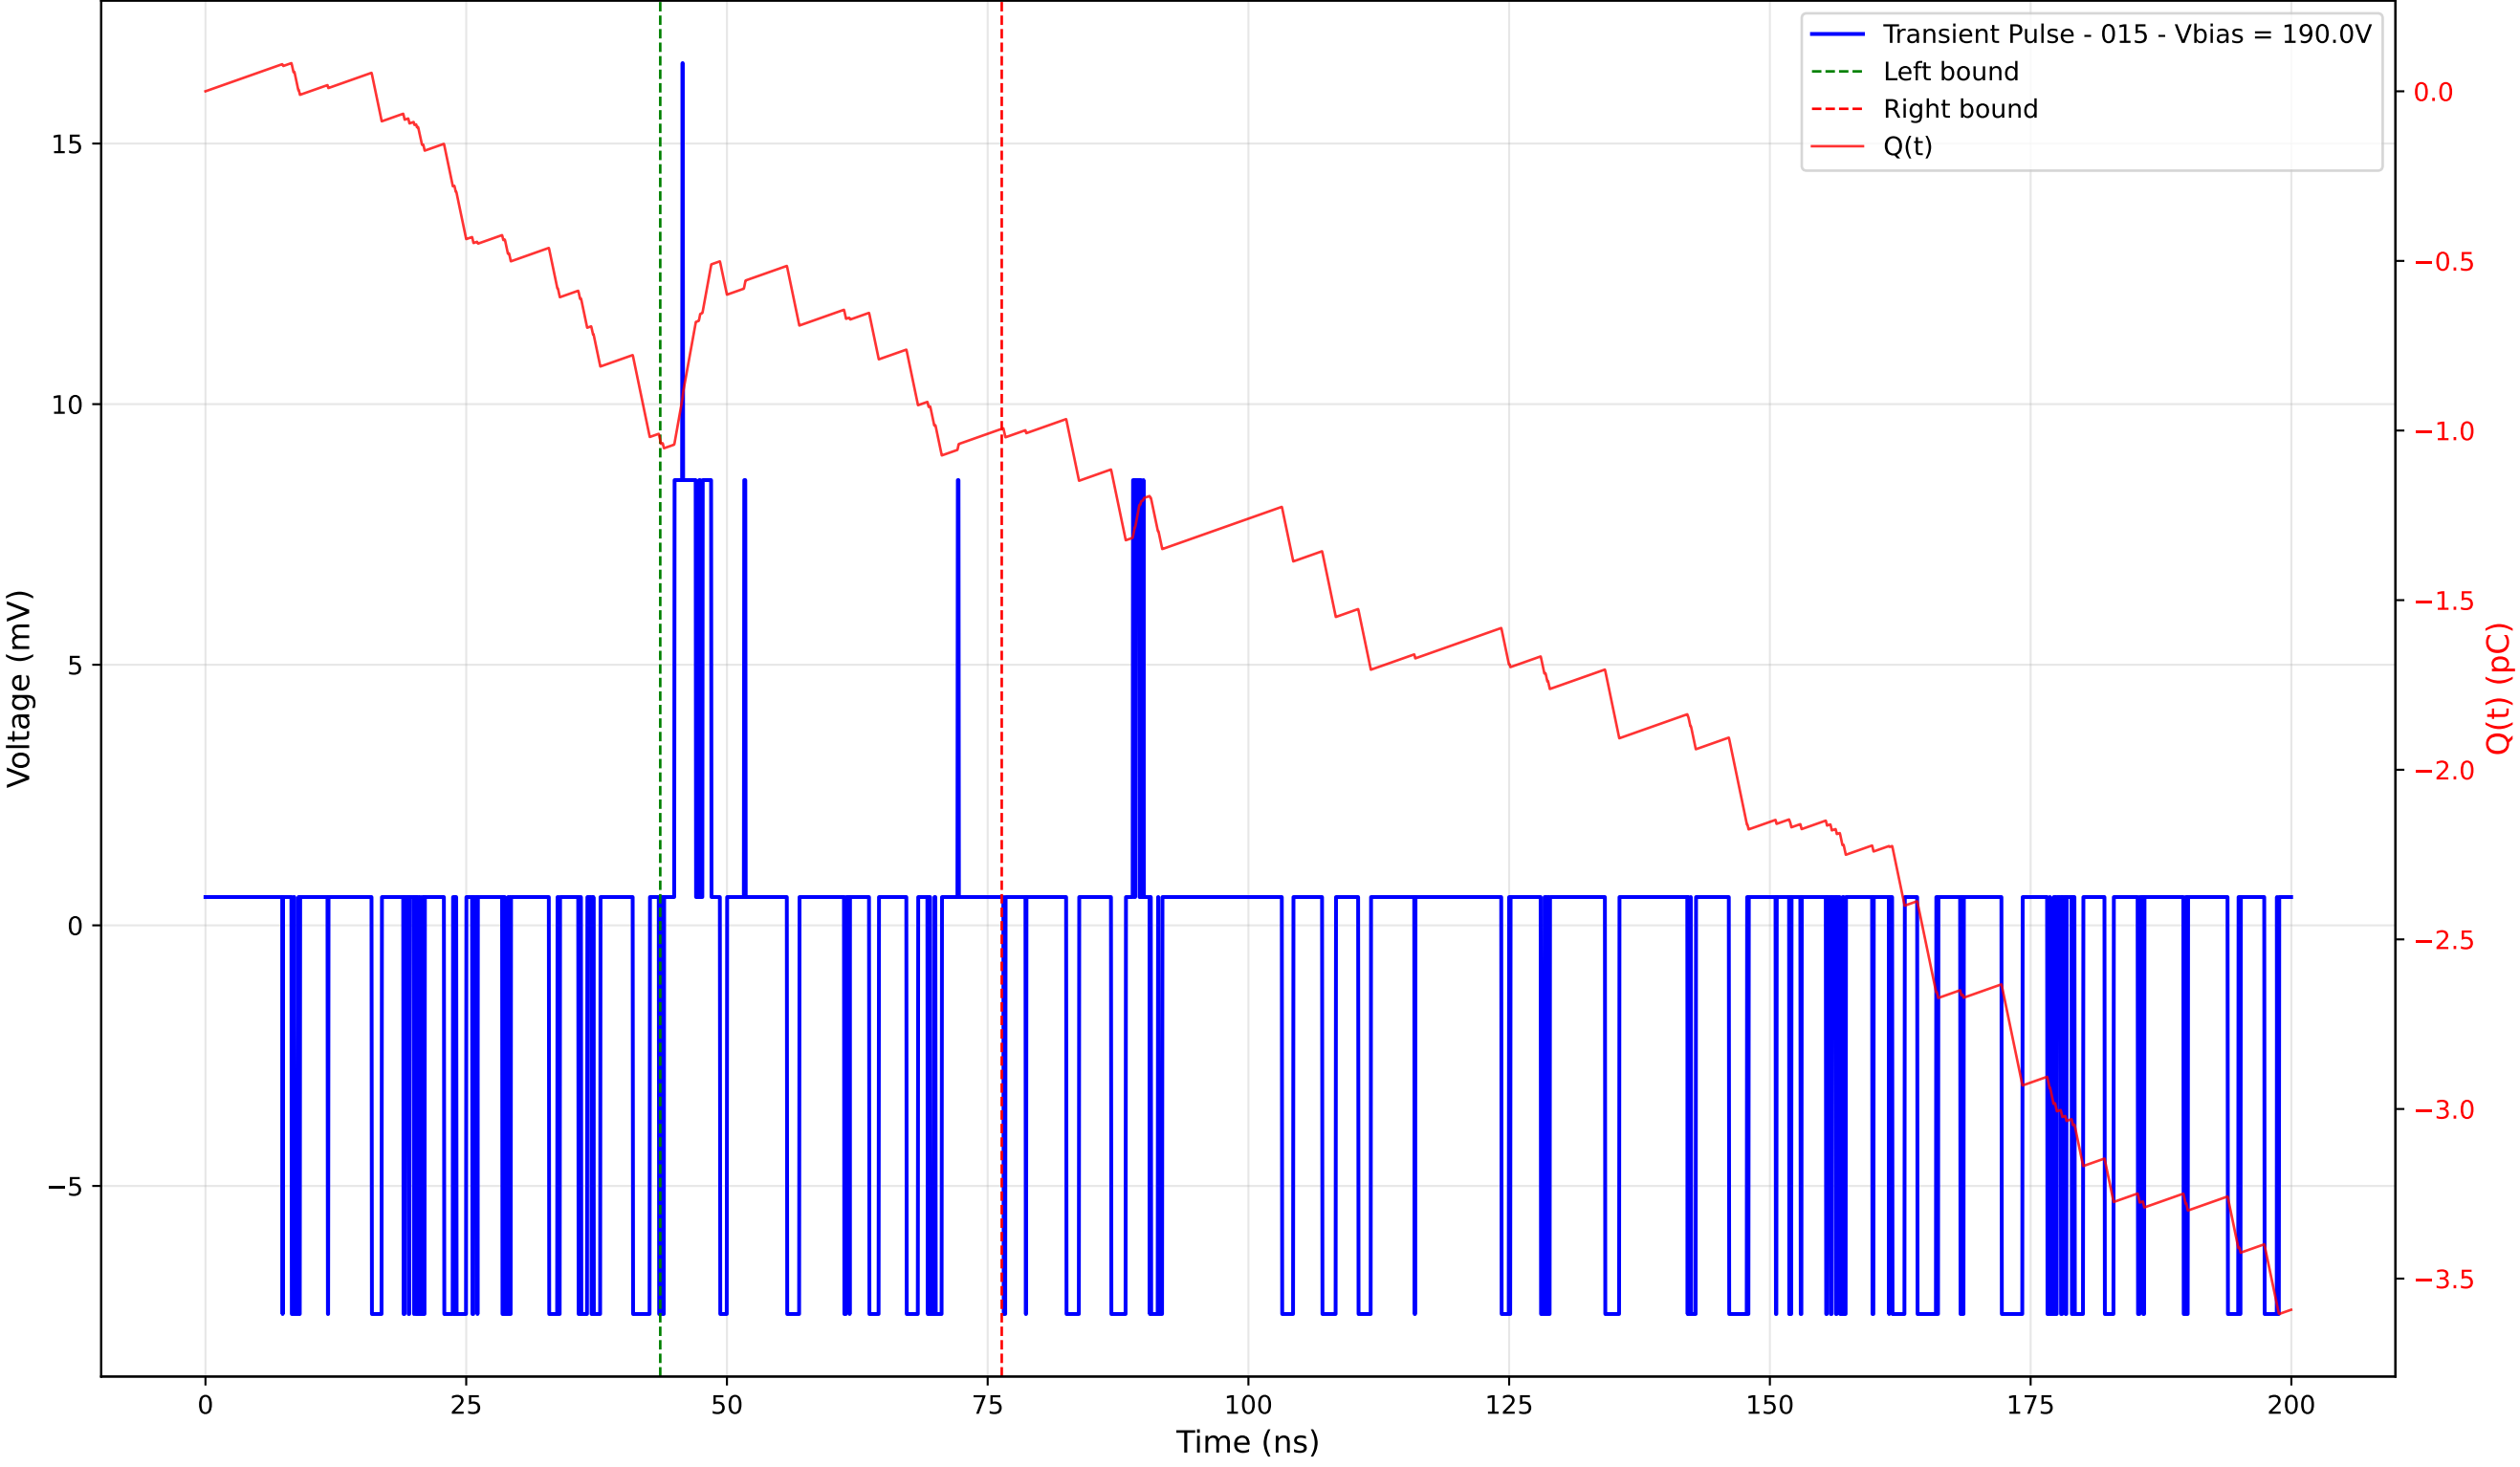


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 0.64 pC - Rise Time: 0.58 ns

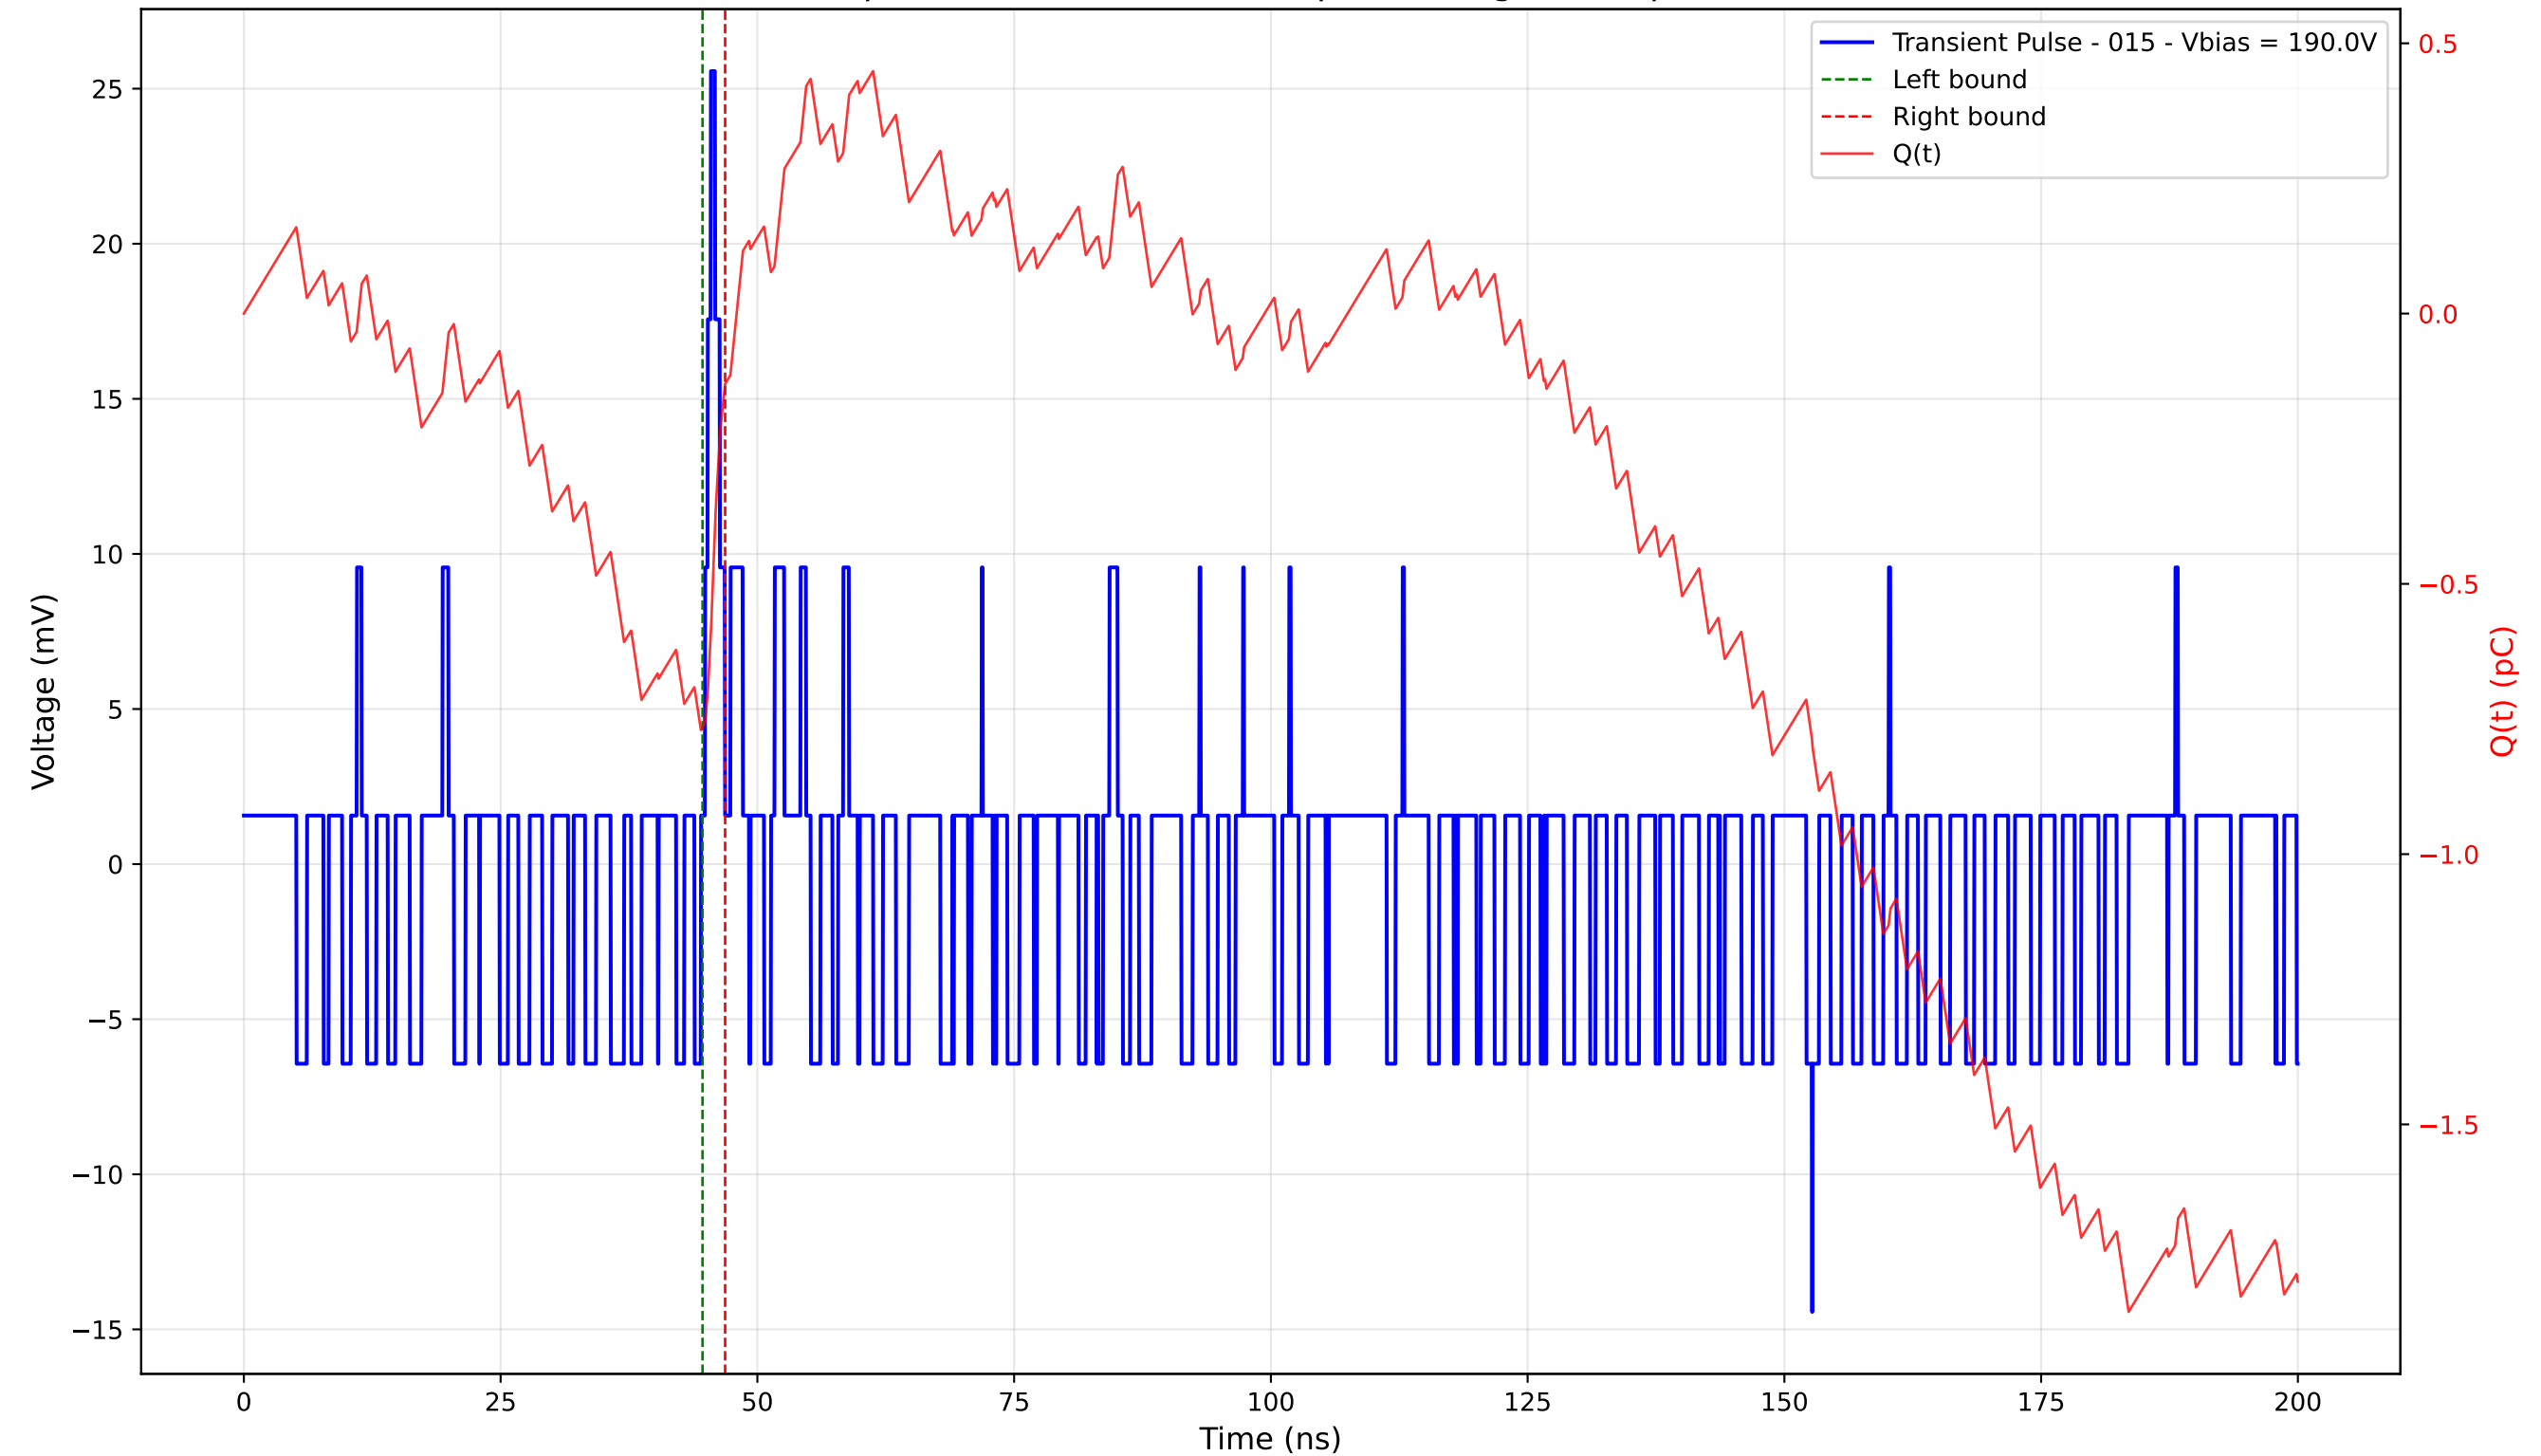


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 0.98 pC - Rise Time: 0.72 ns

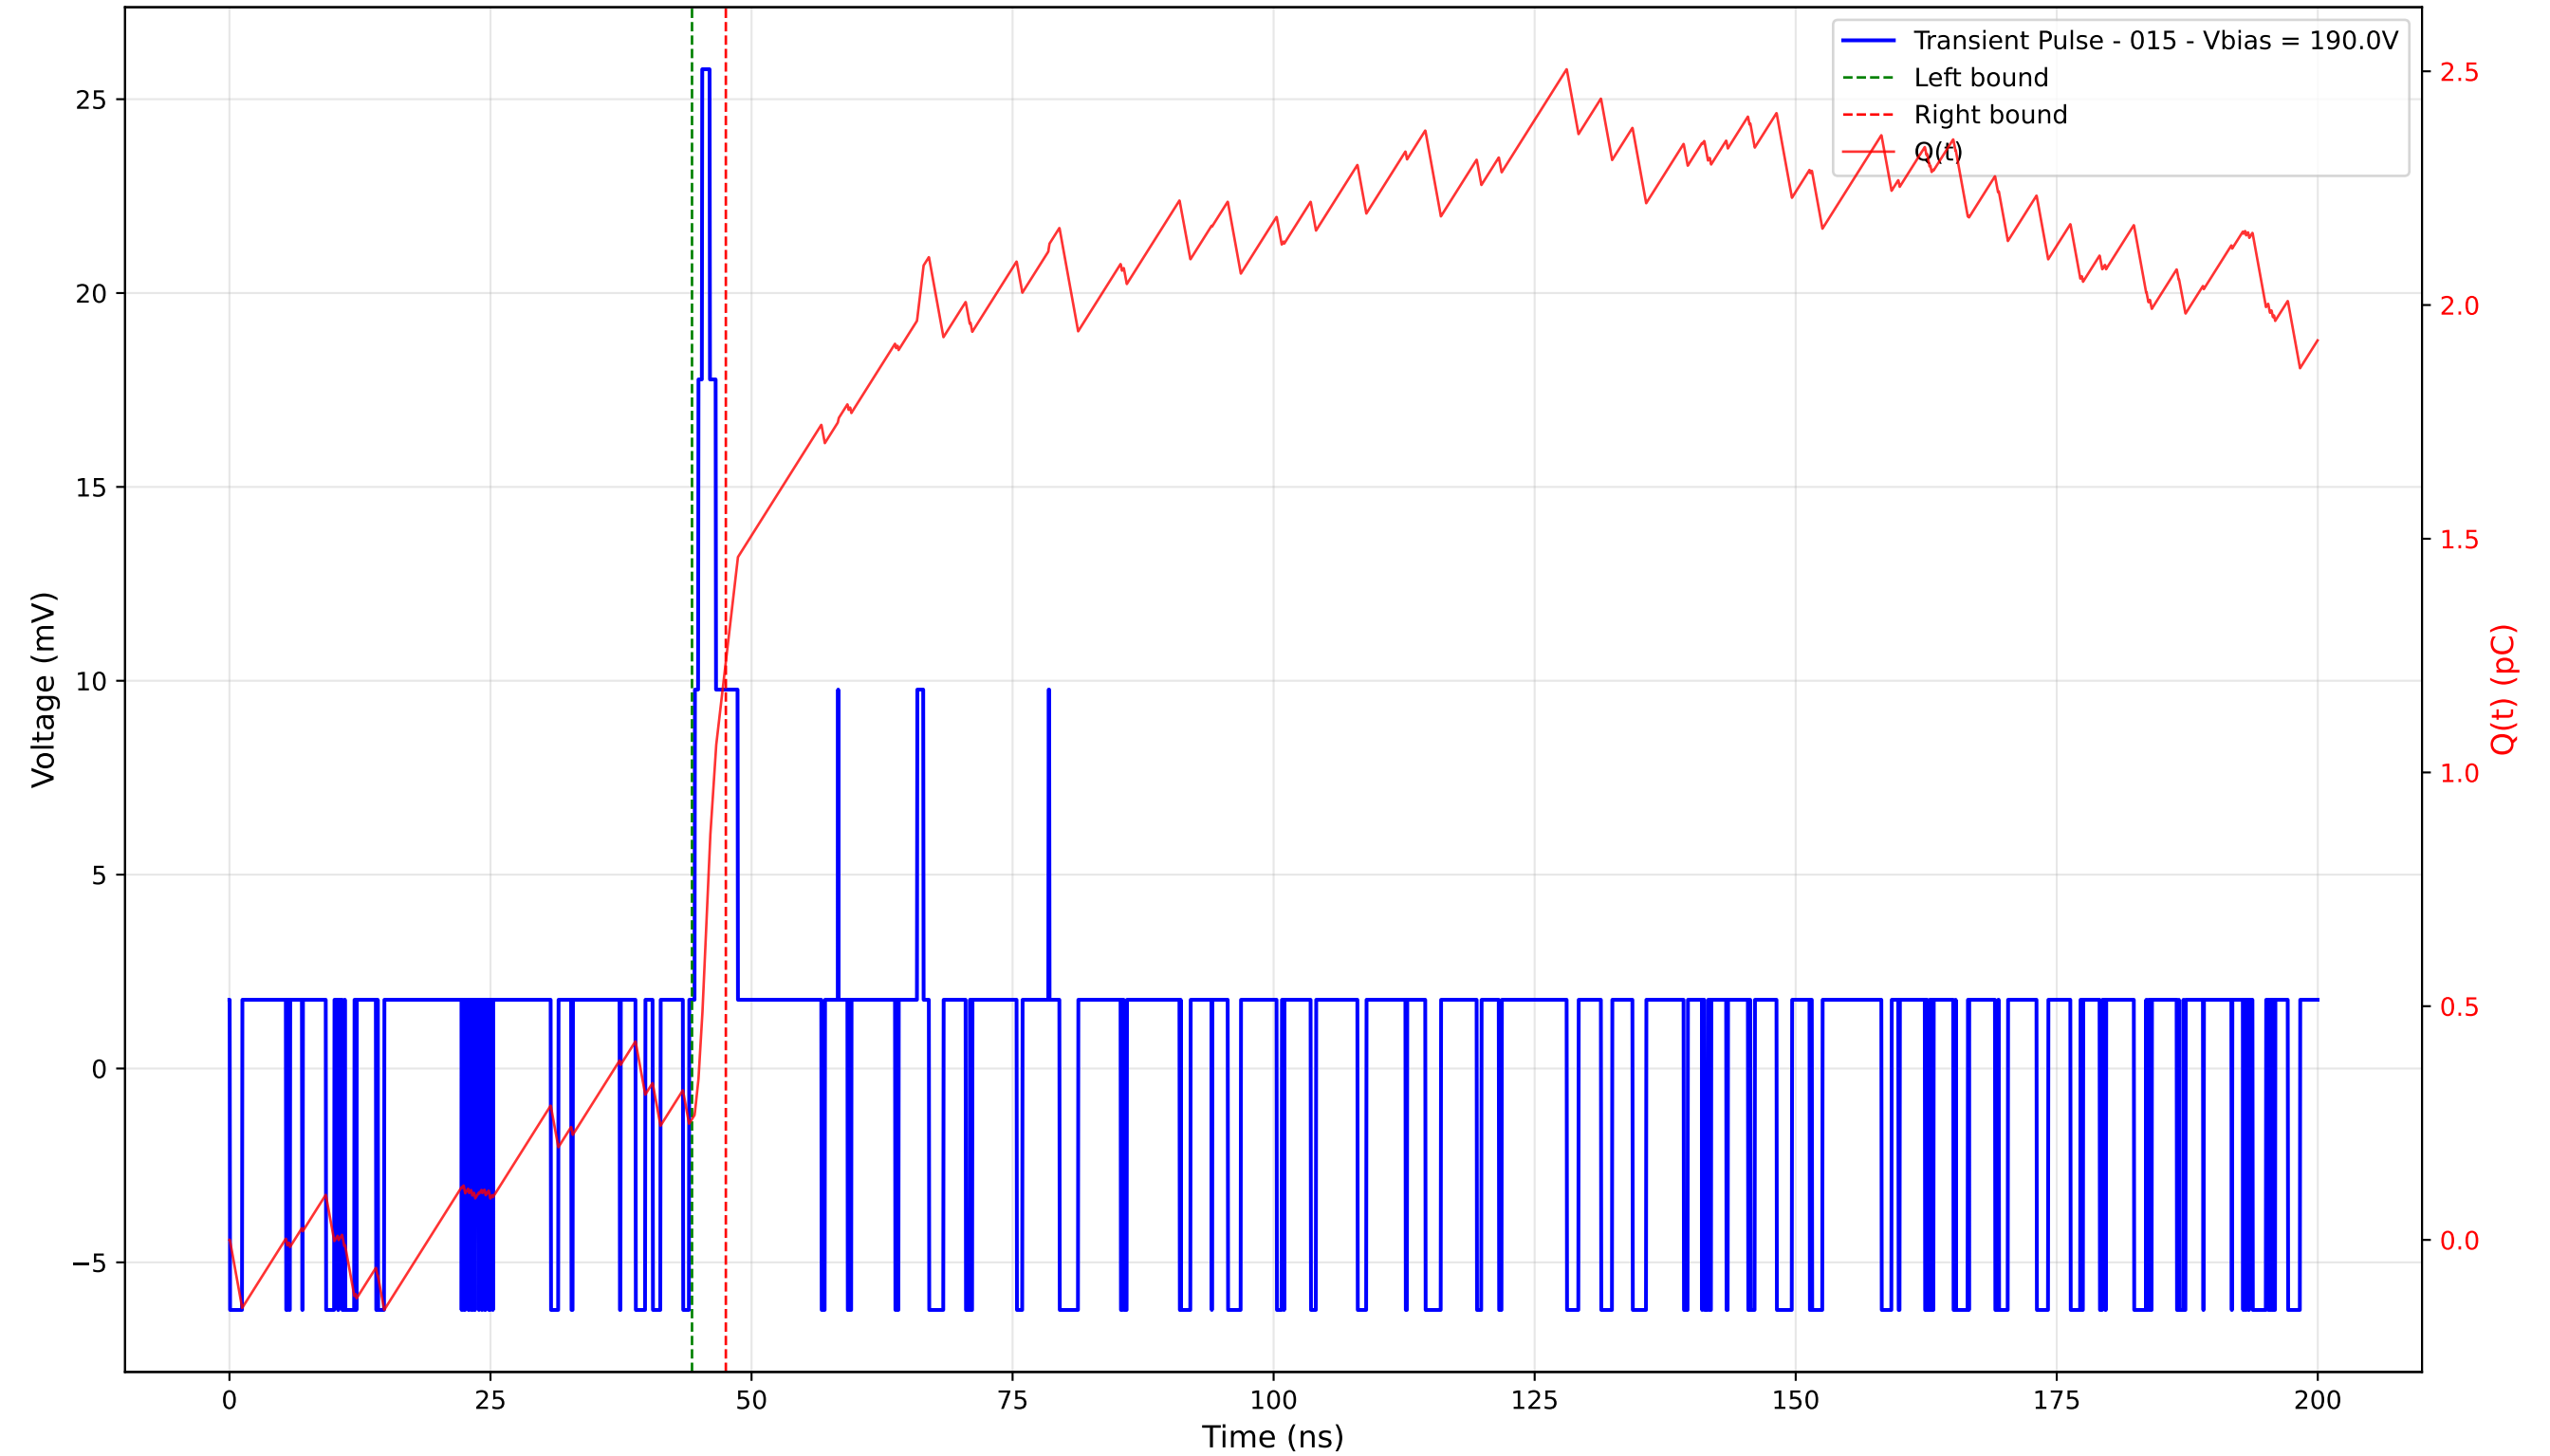


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.31 pC - Rise Time: 1.06 ns

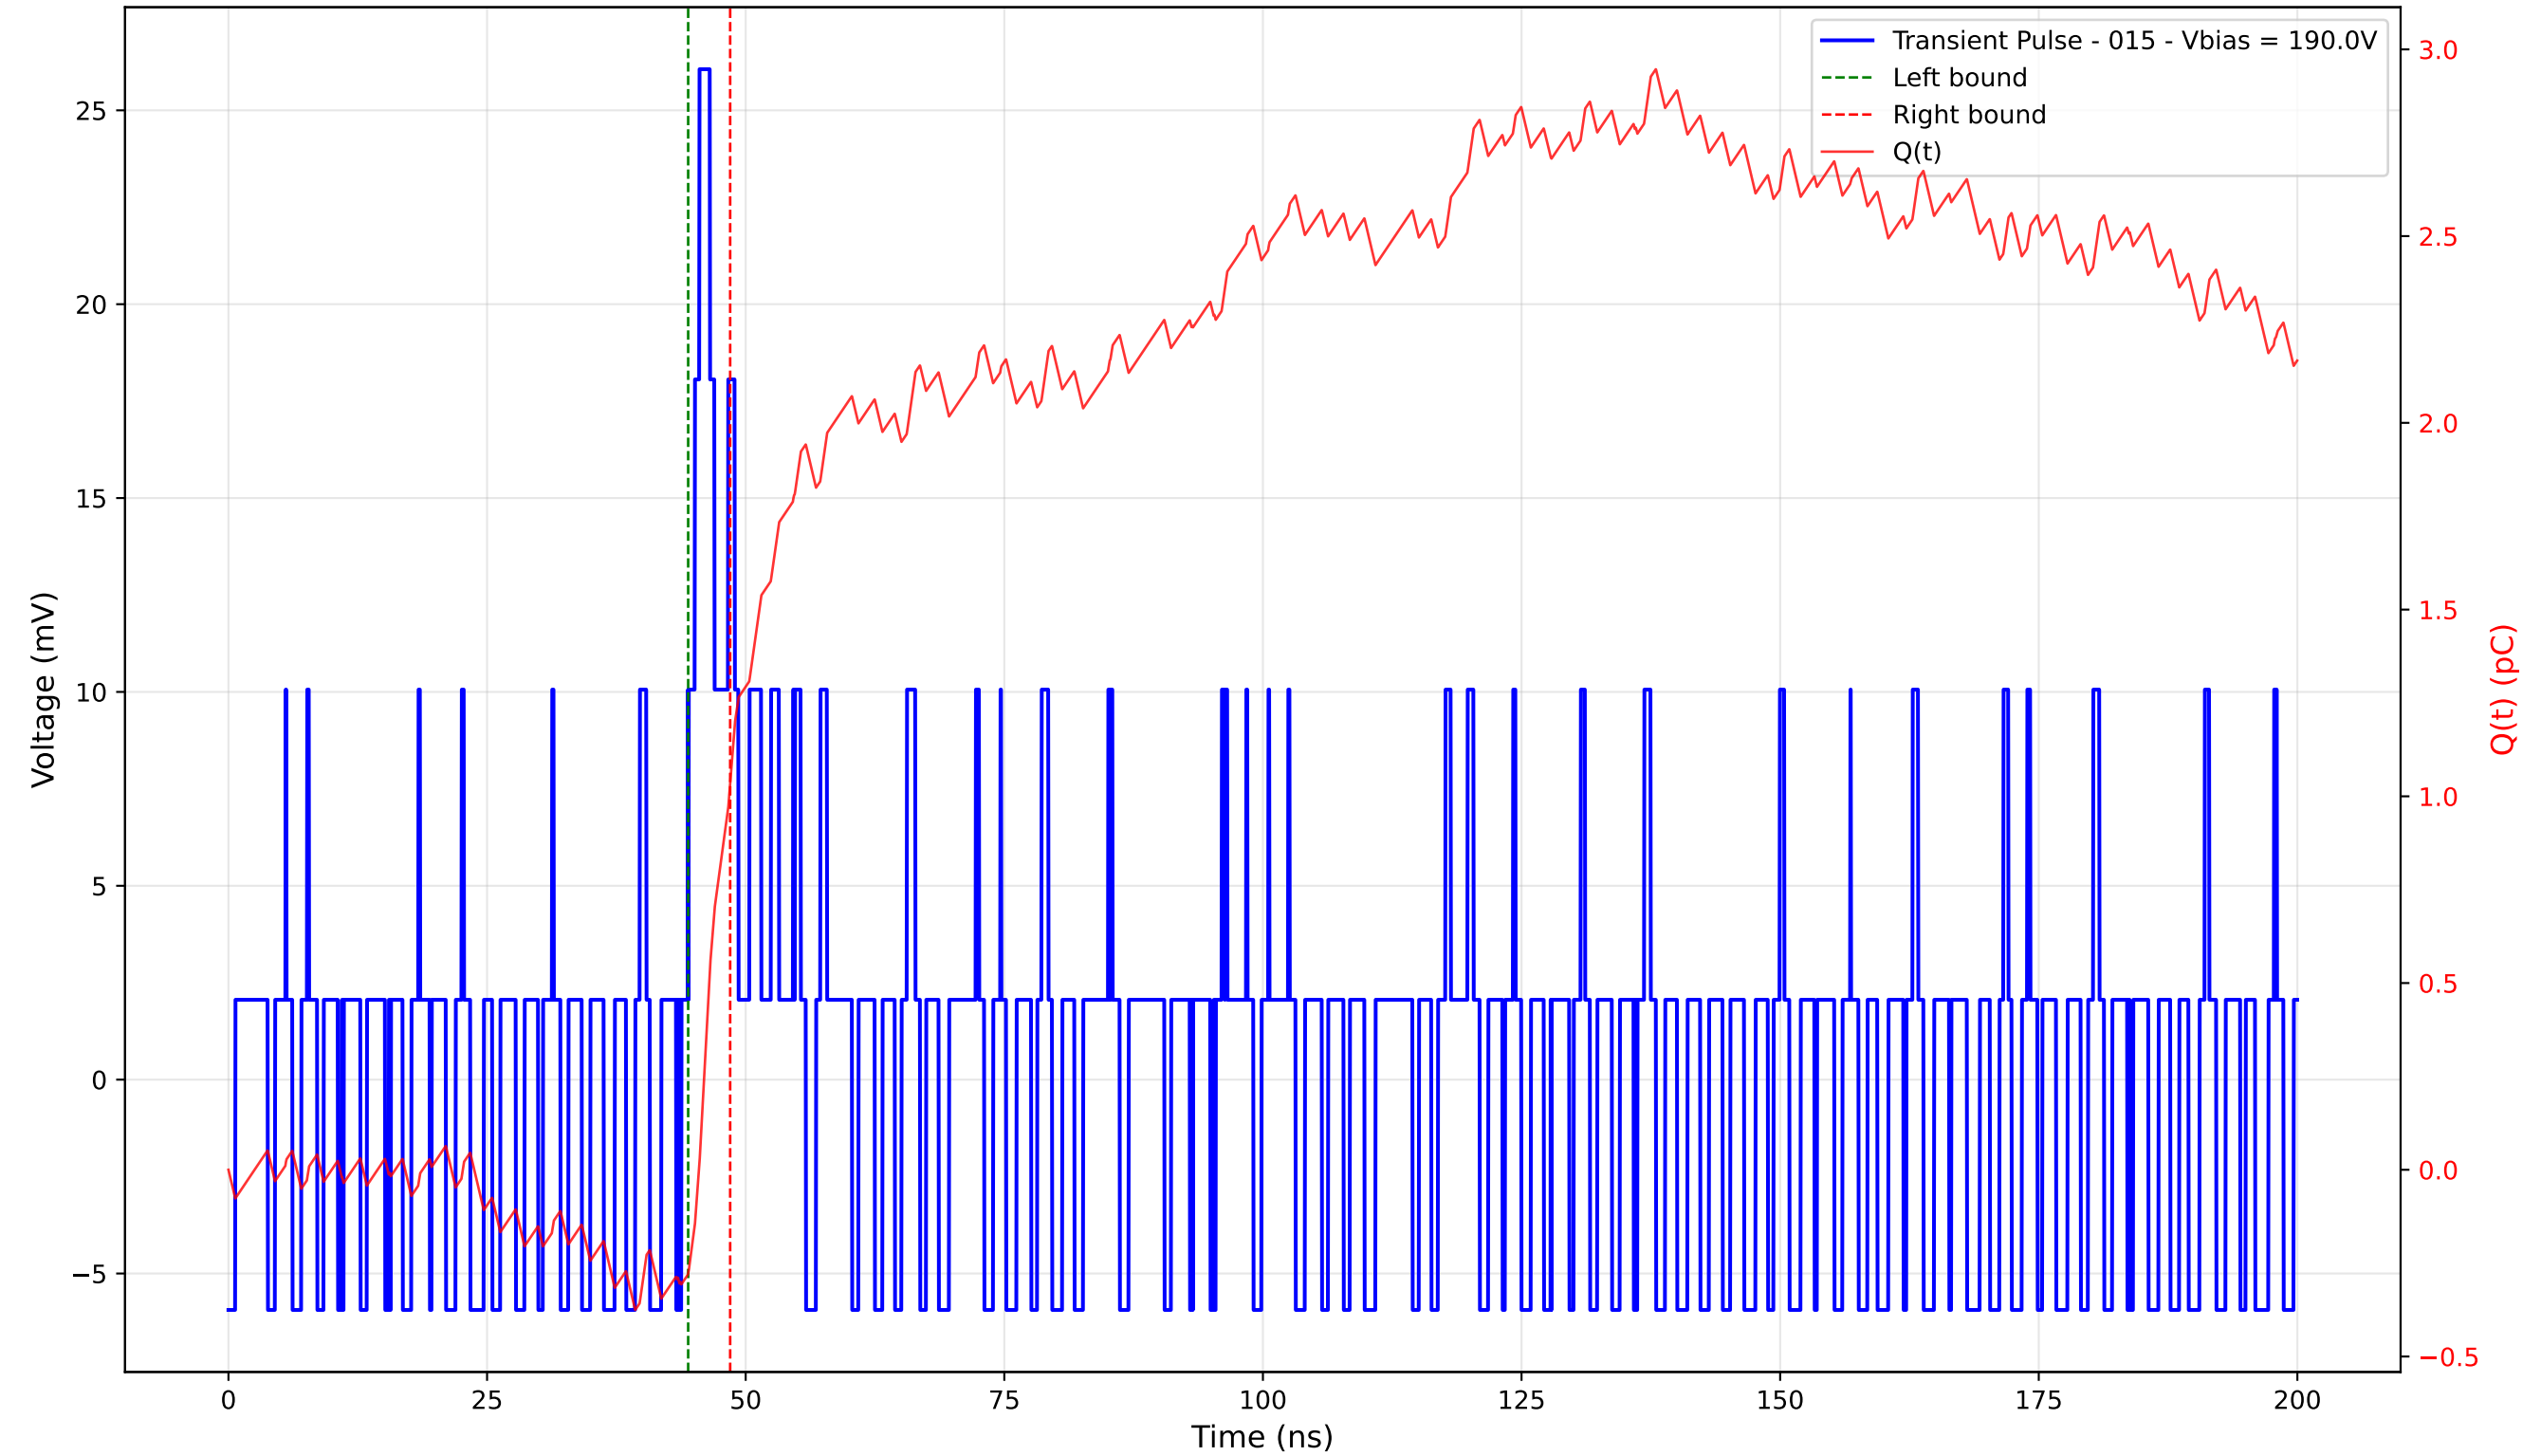


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.50 pC - Rise Time: 0.78 ns

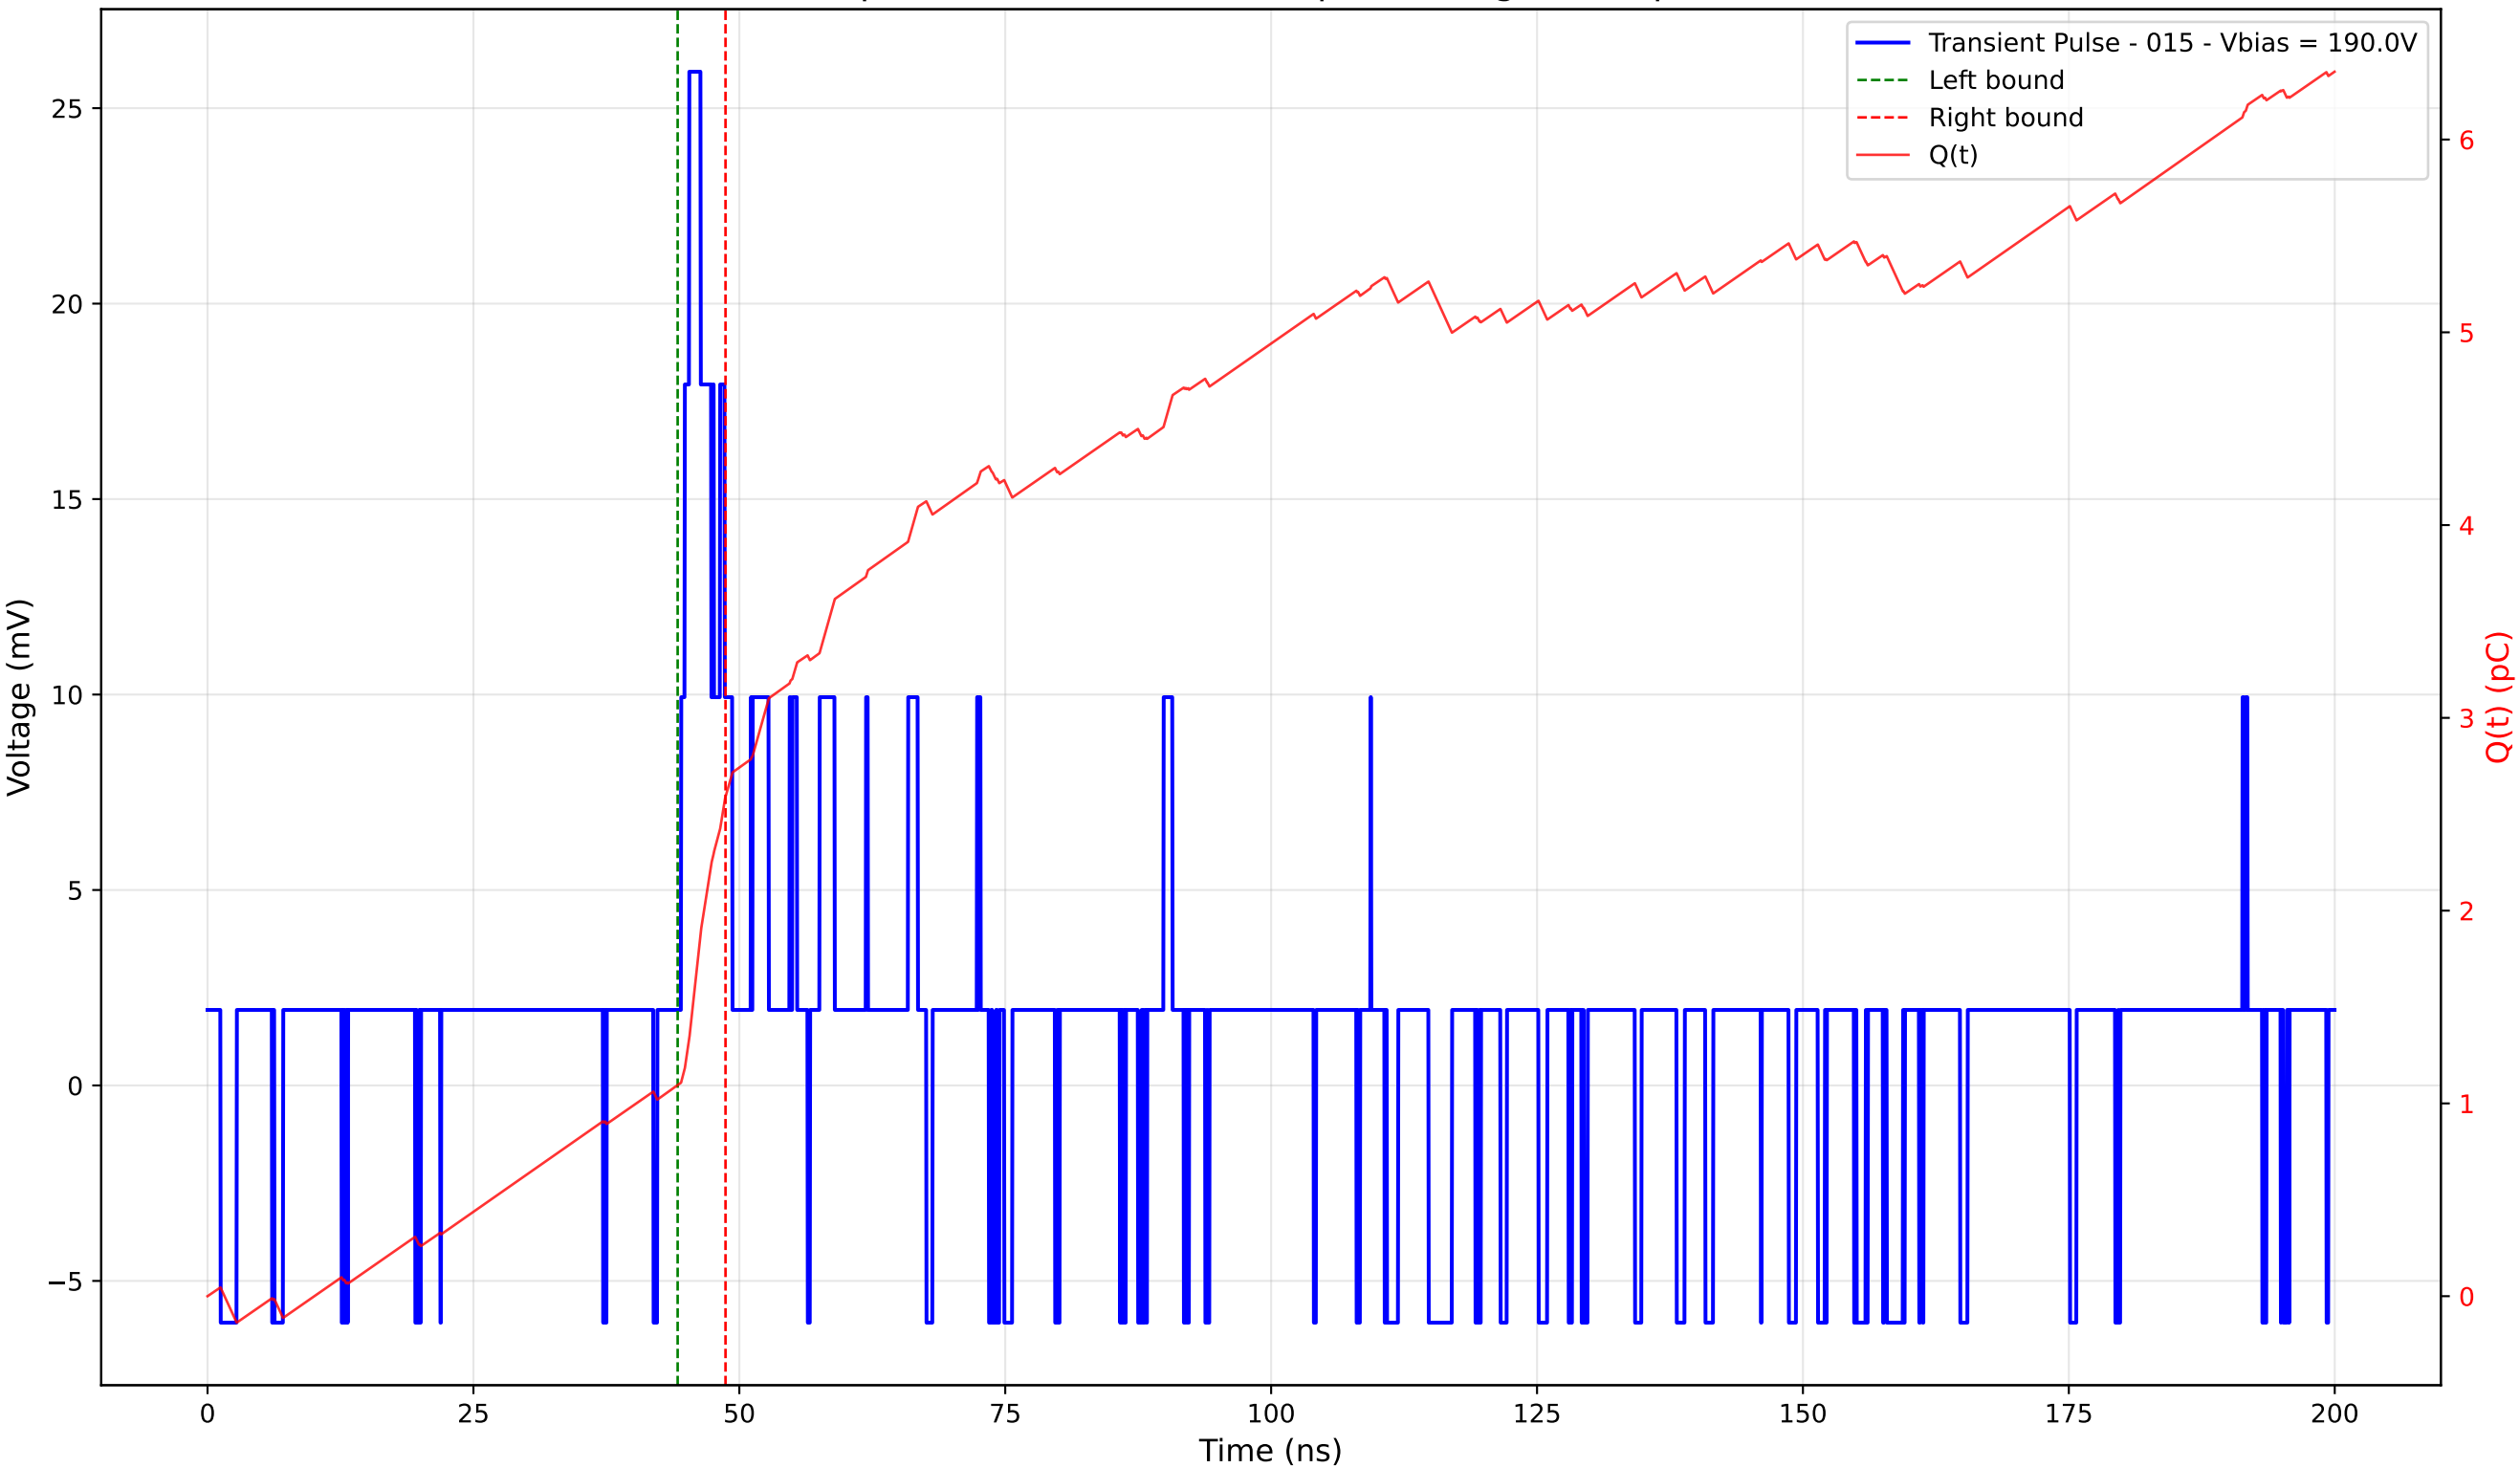


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.66 pC - Rise Time: 0.45 ns

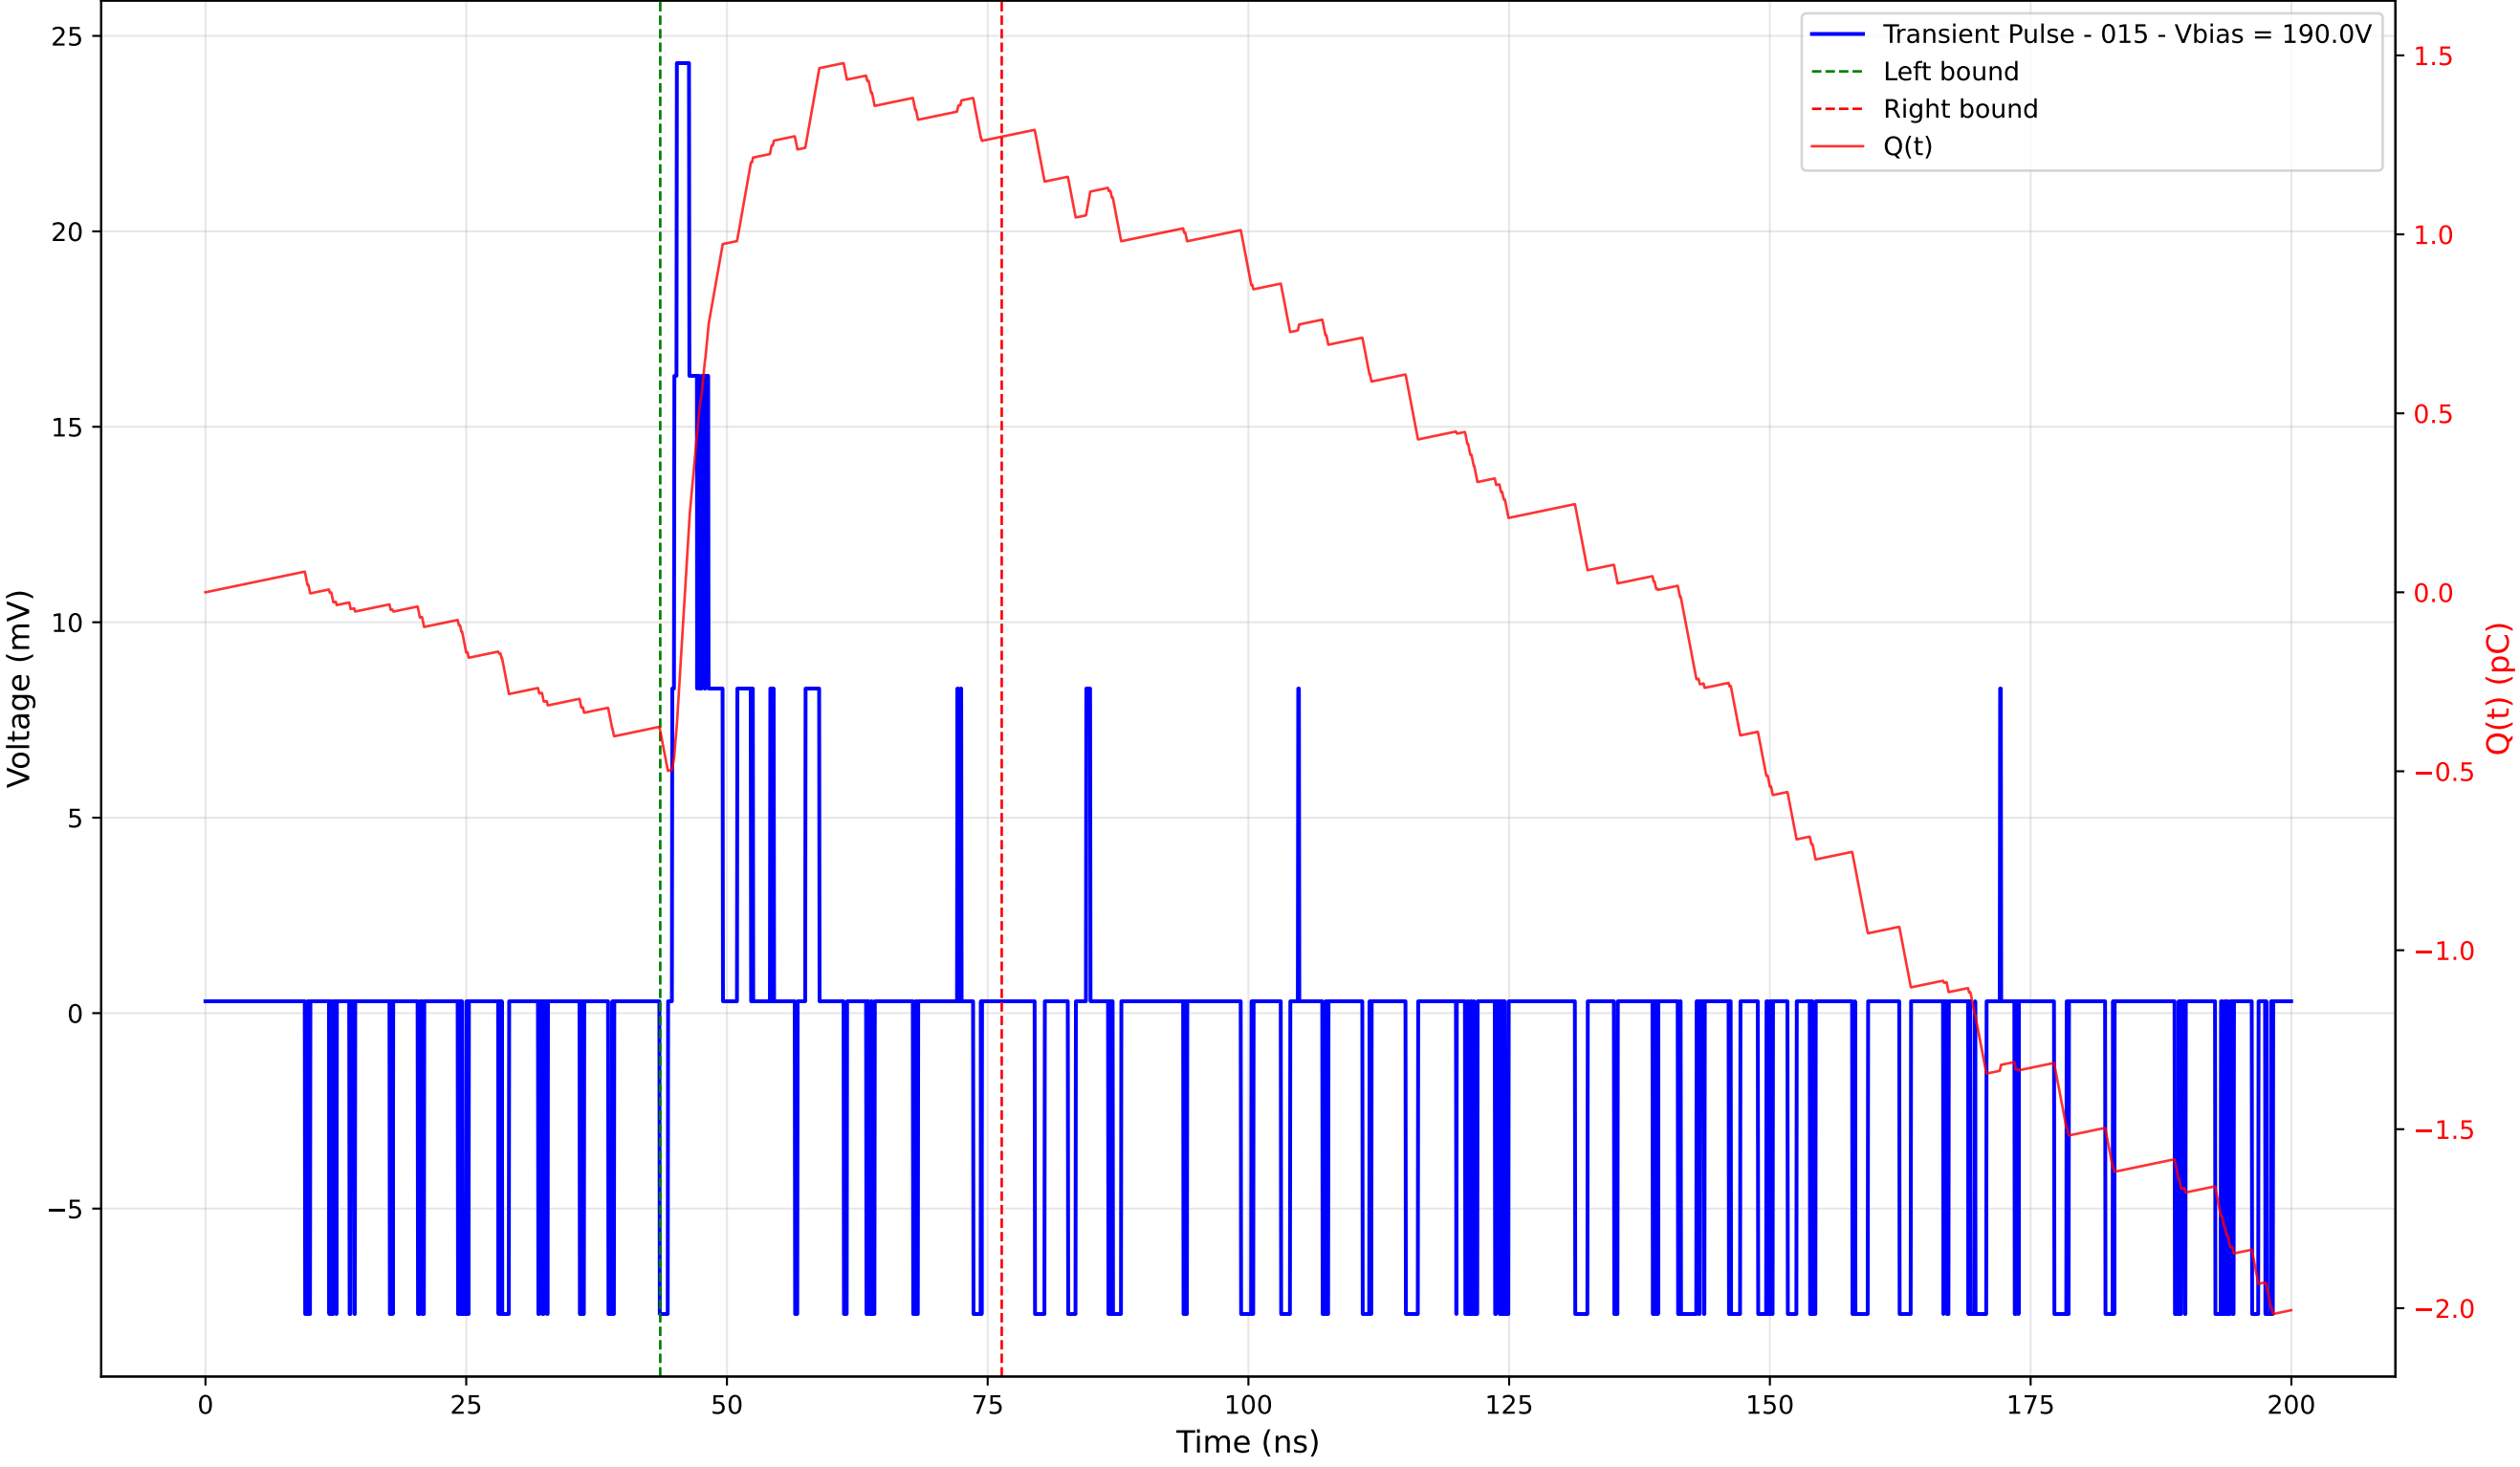


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.60 pC - Rise Time: 1.08 ns

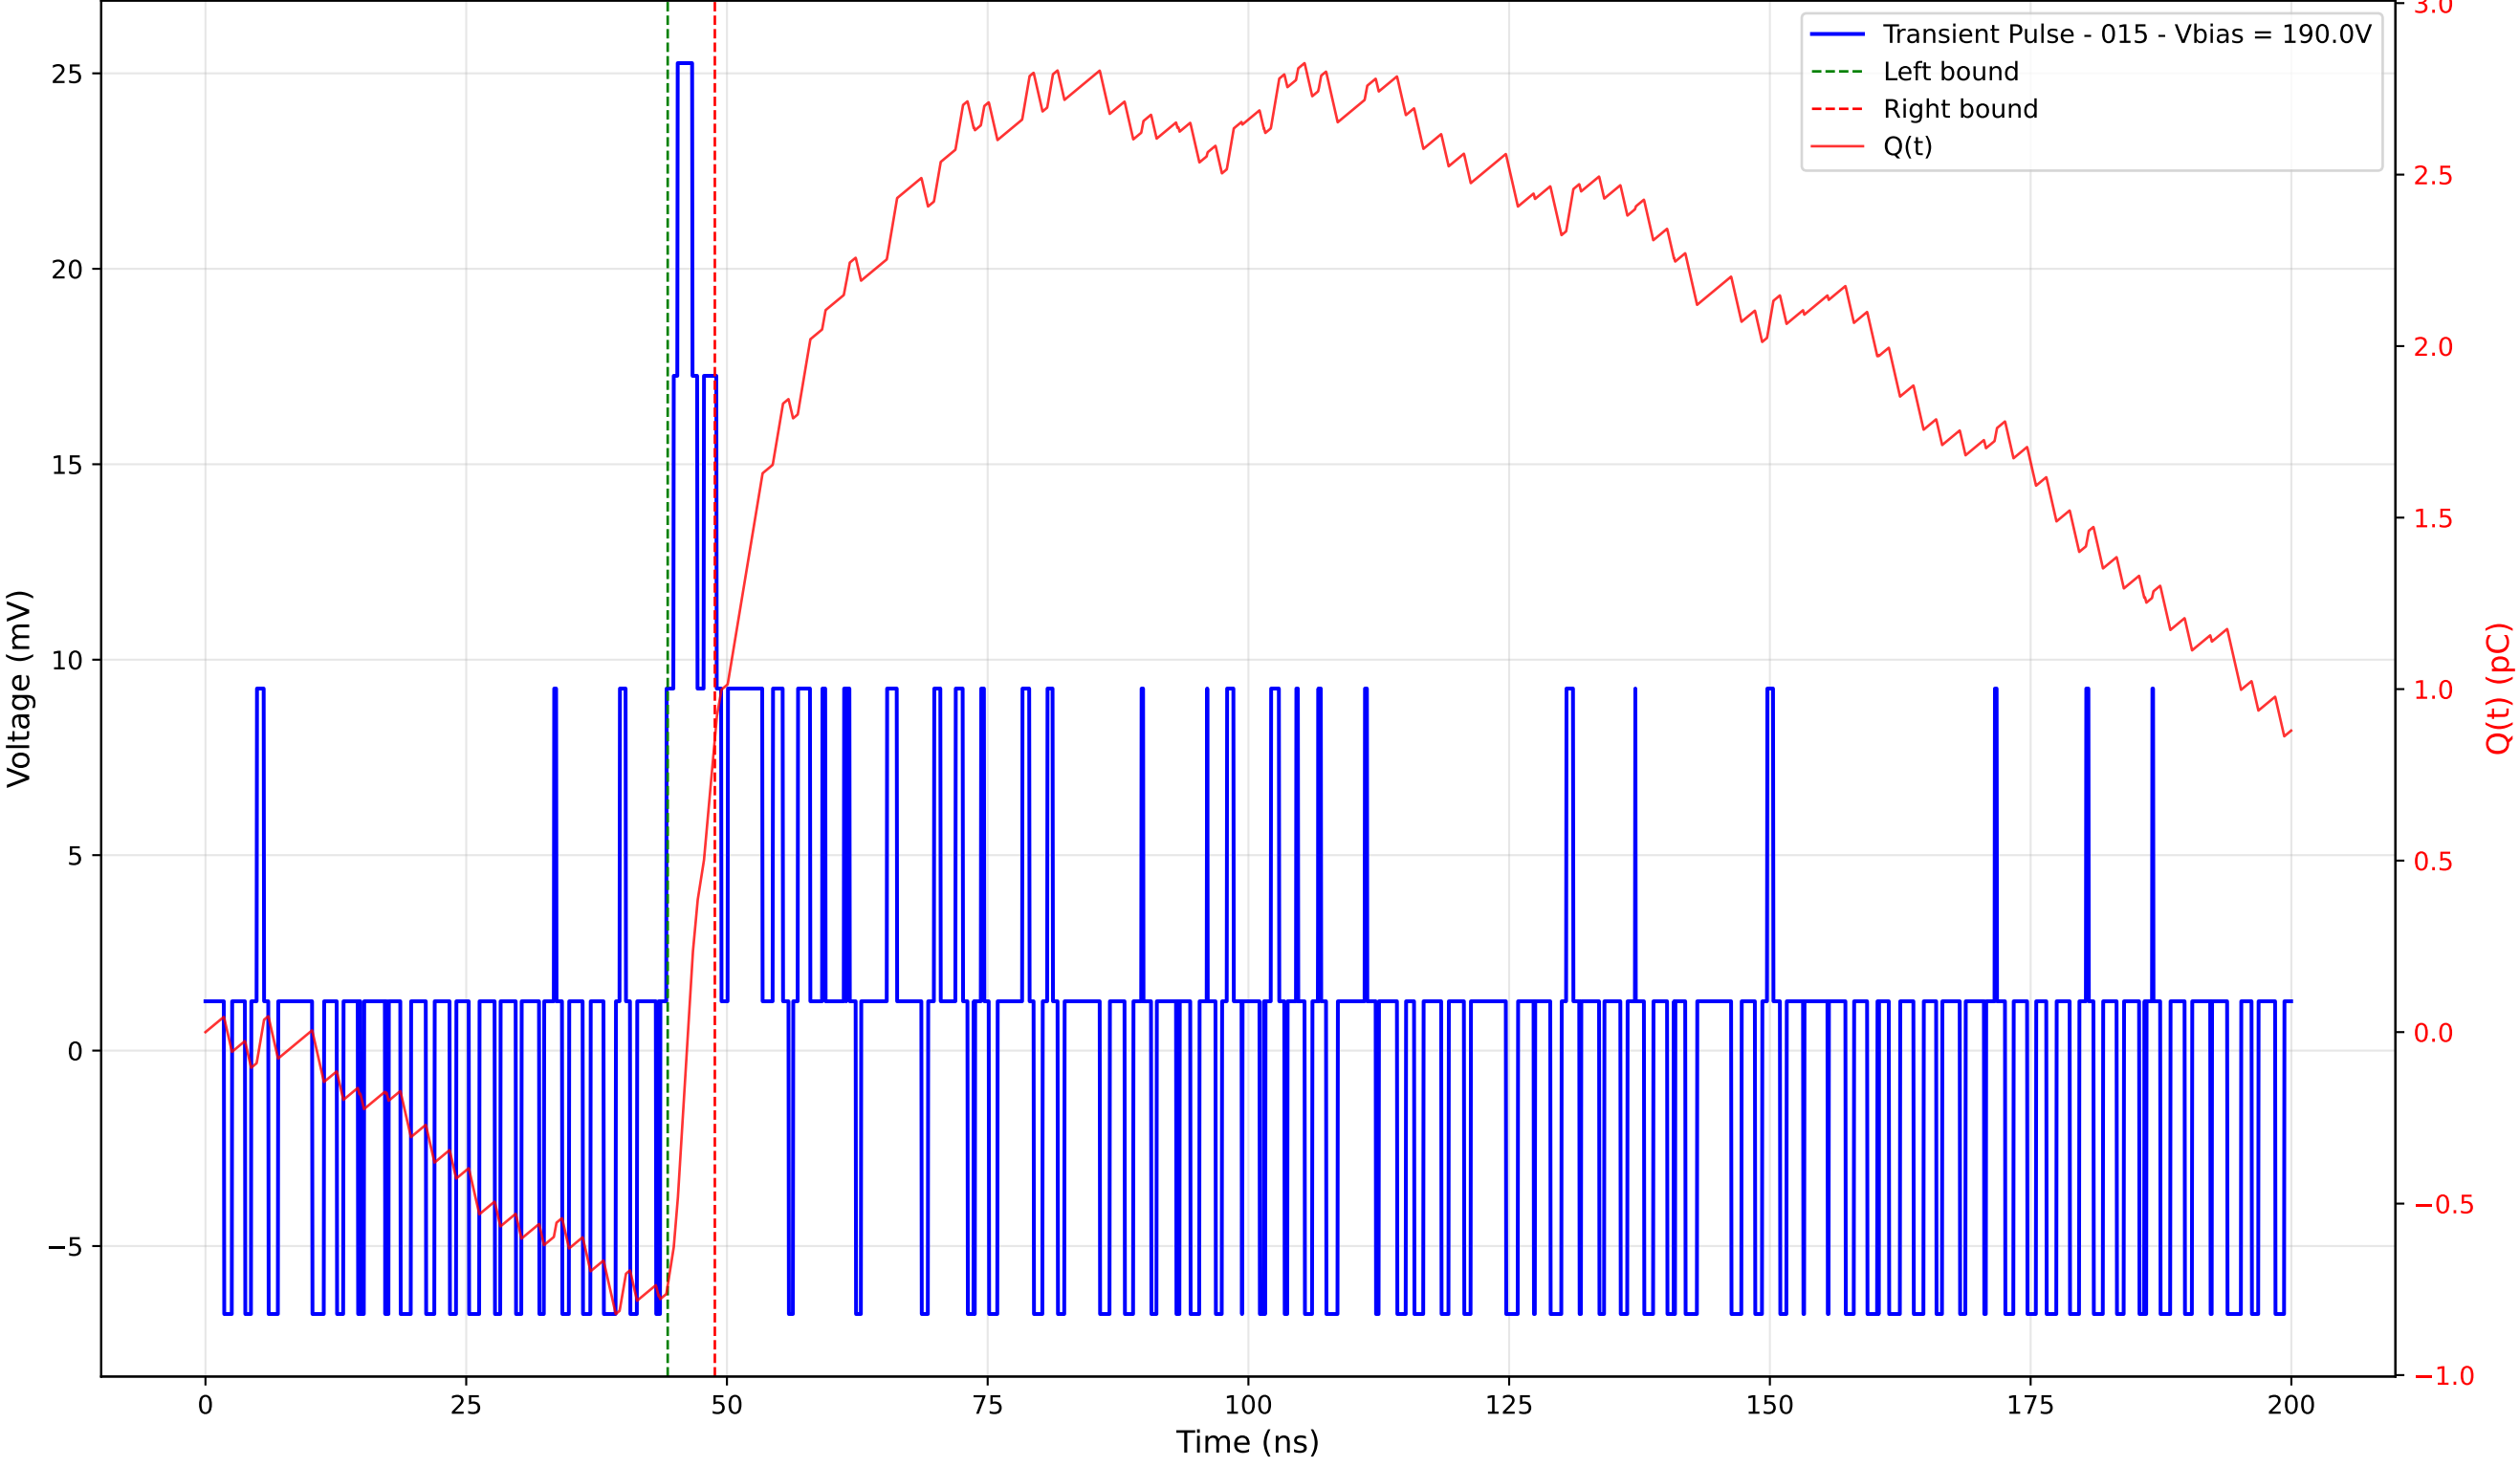


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 1.52 pC - Rise Time: 2.12 ns

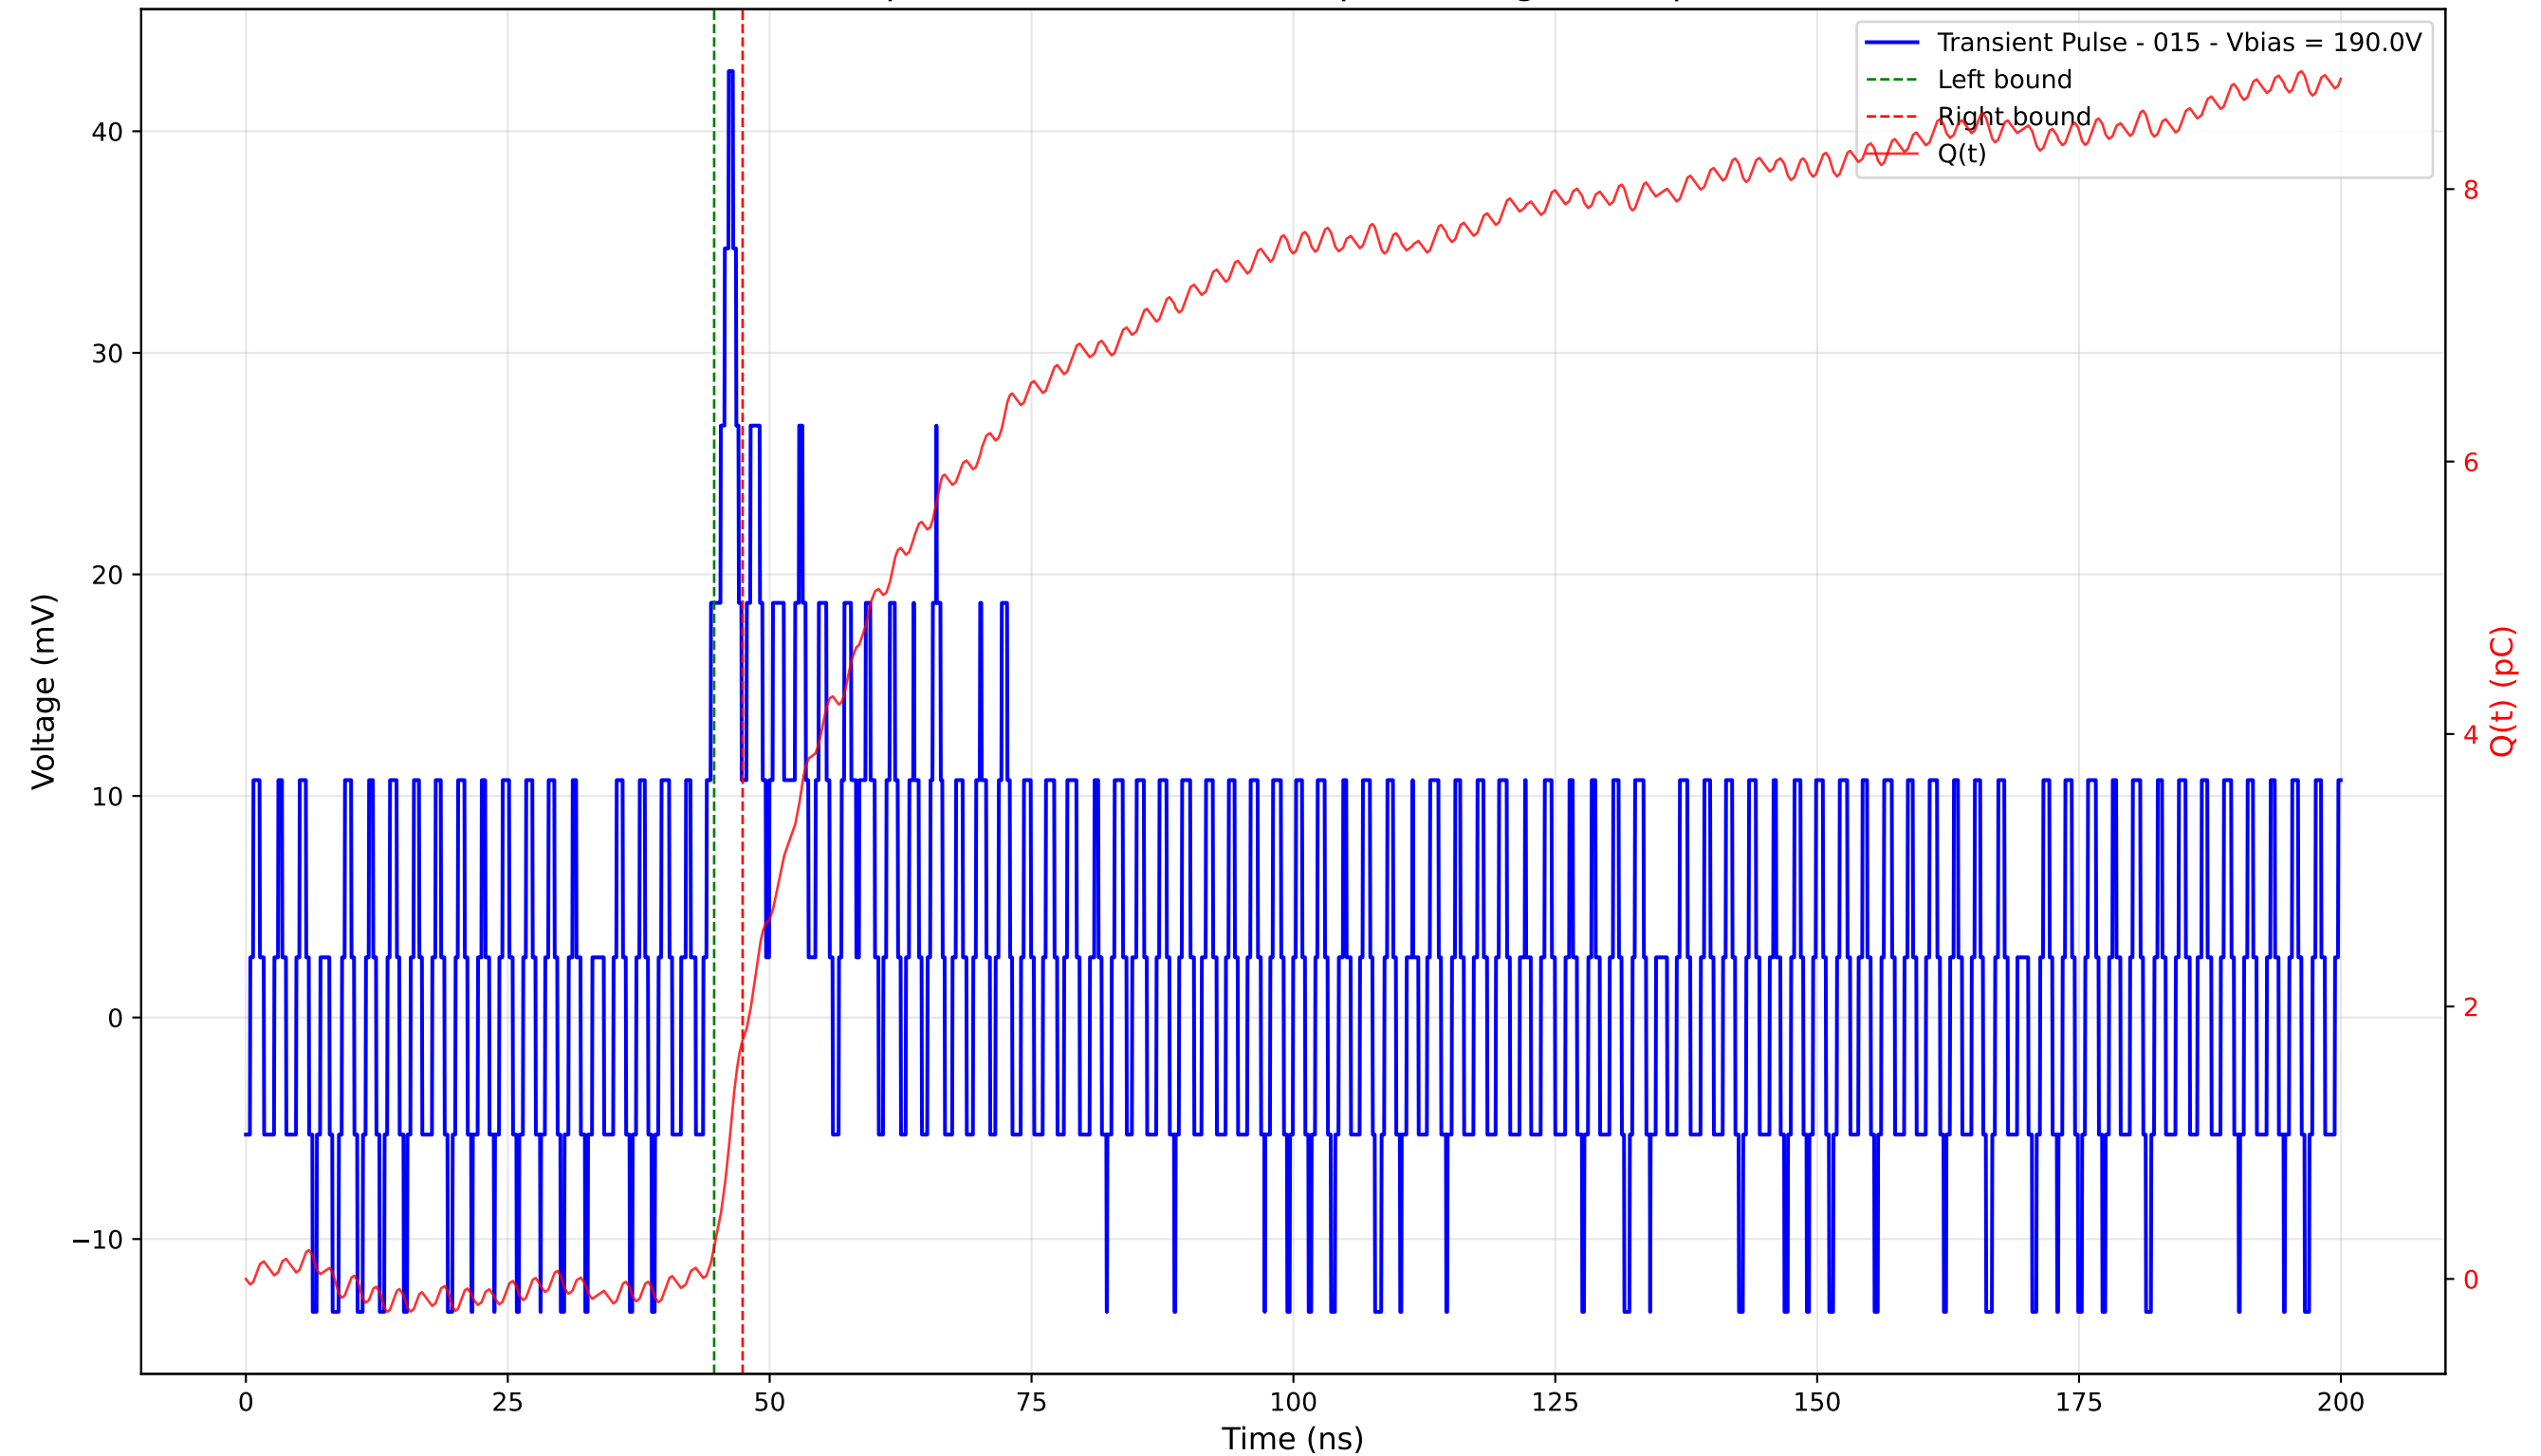


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 5.75 pC - Rise Time: 0.97 ns

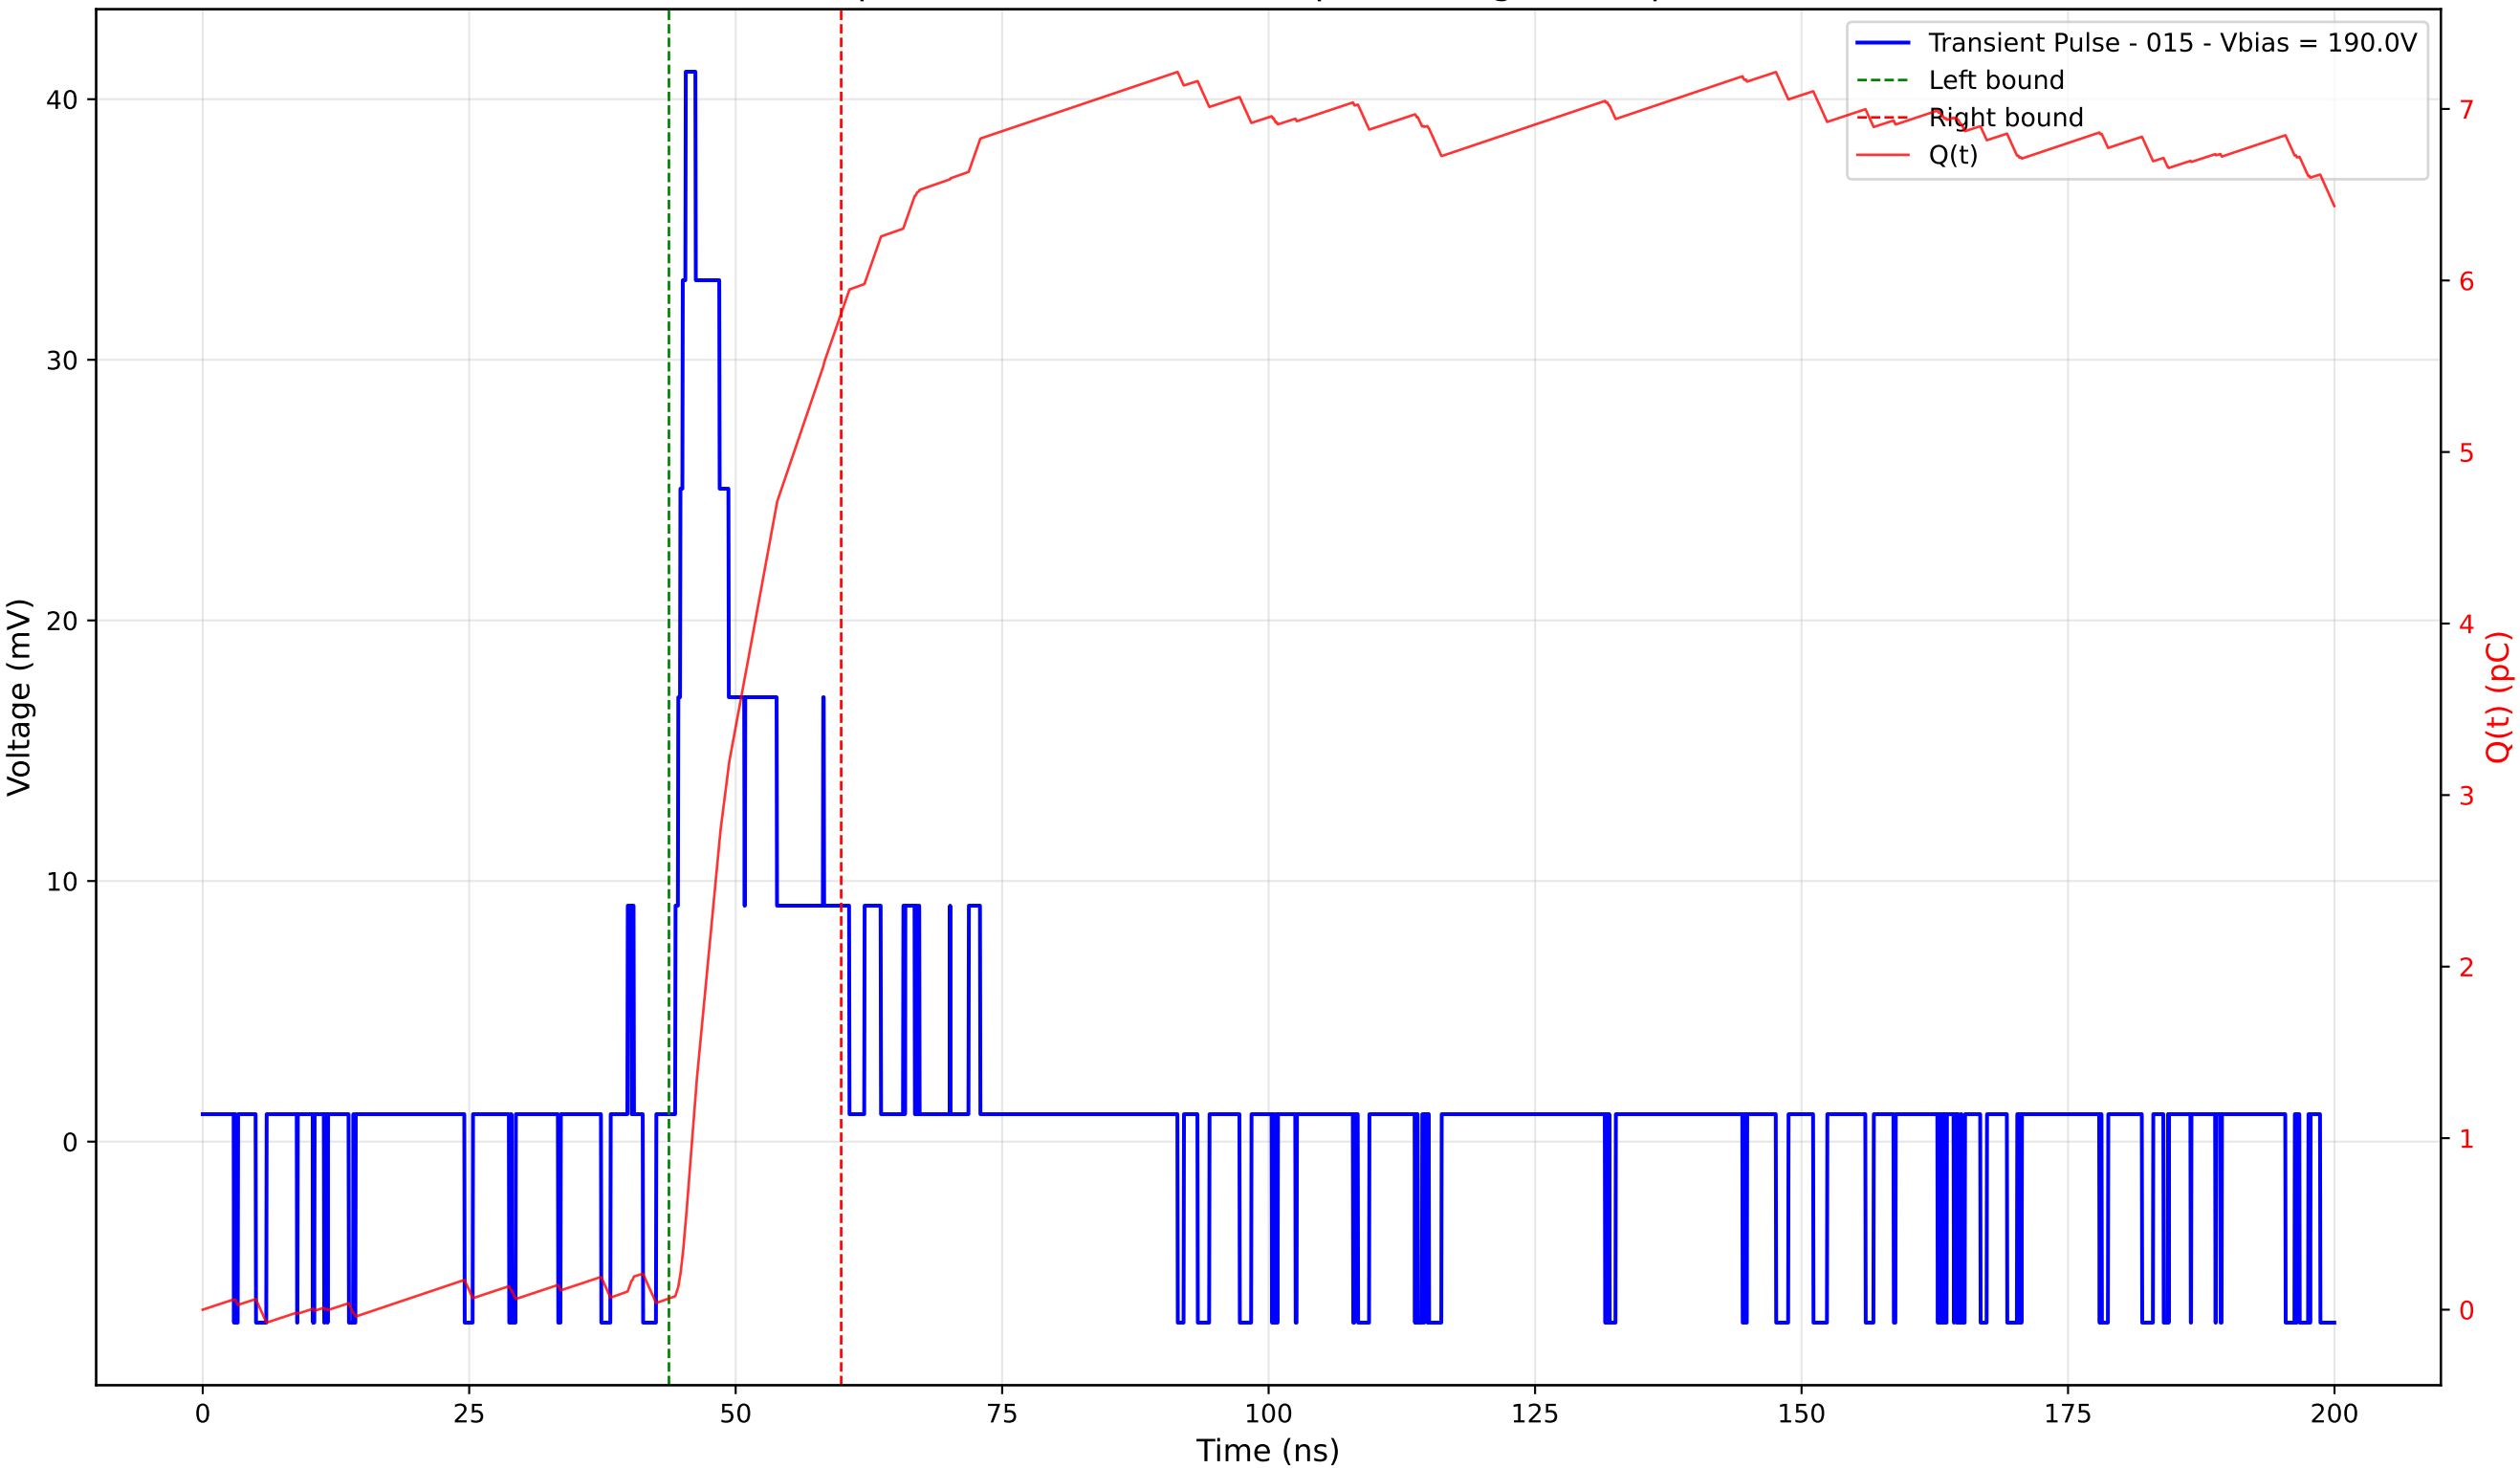


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 5.64 pC - Rise Time: 1.63 ns

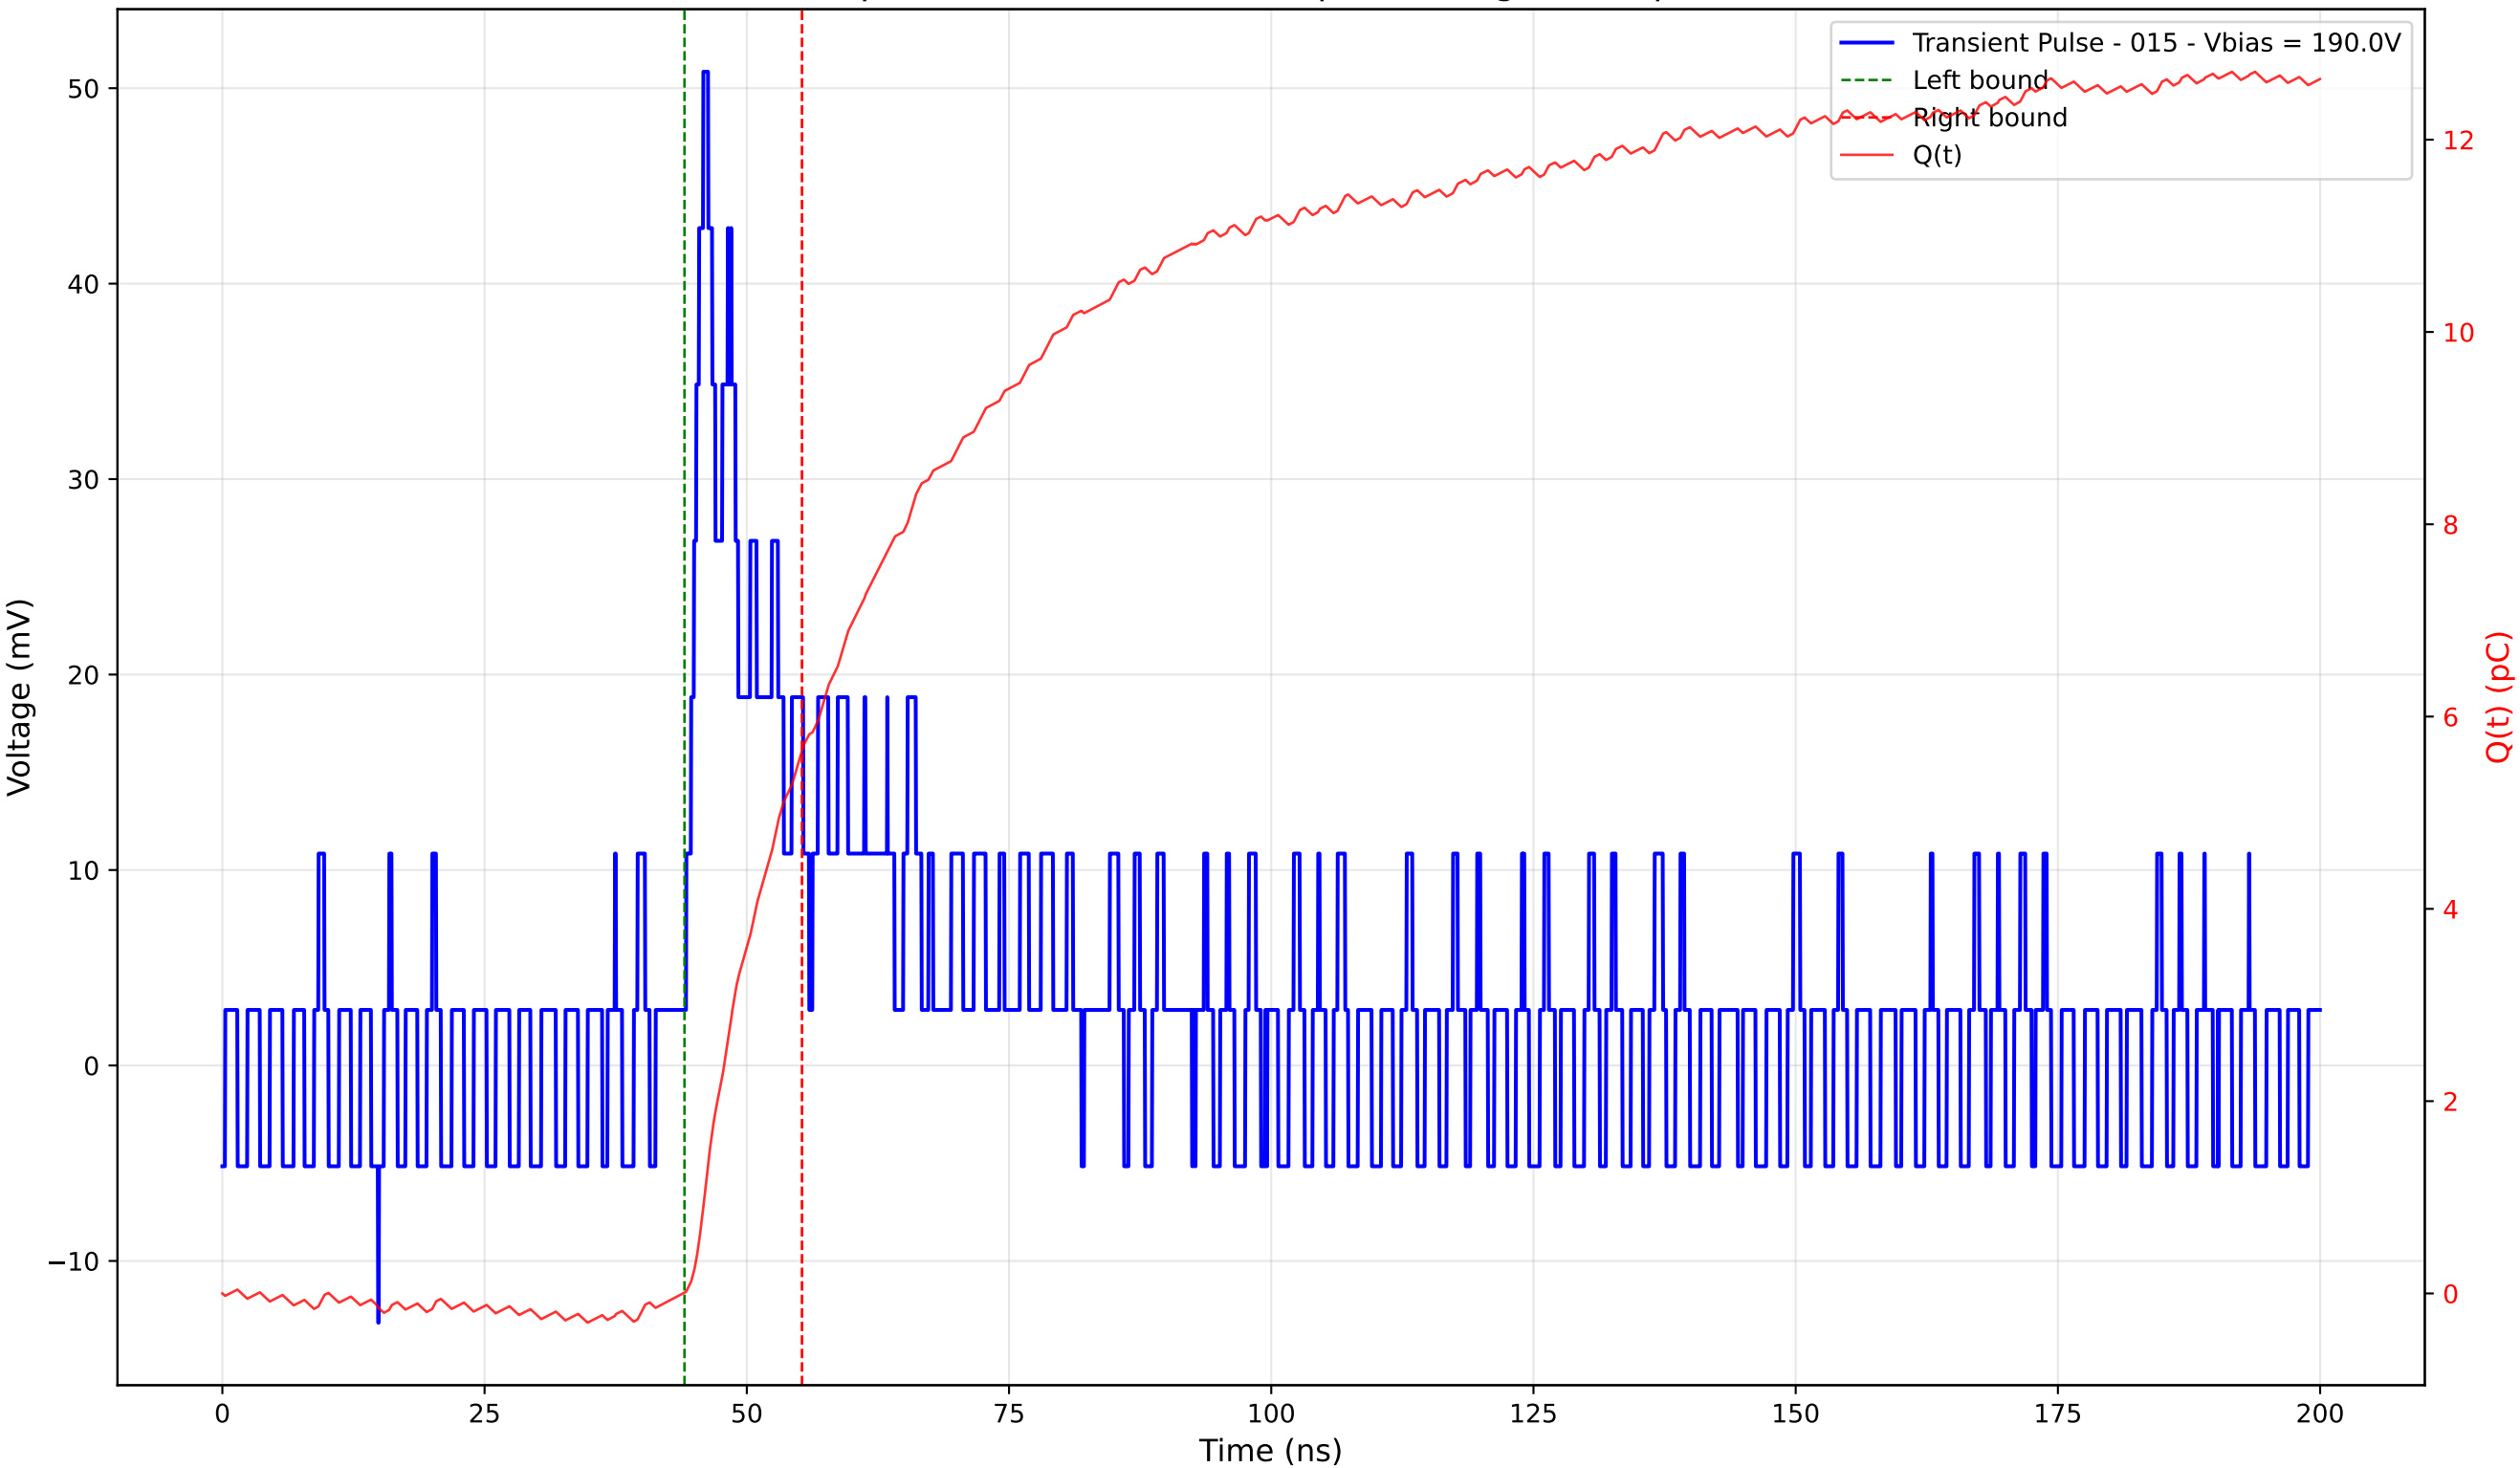

Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 5.16 pC - Rise Time: 0.80 ns

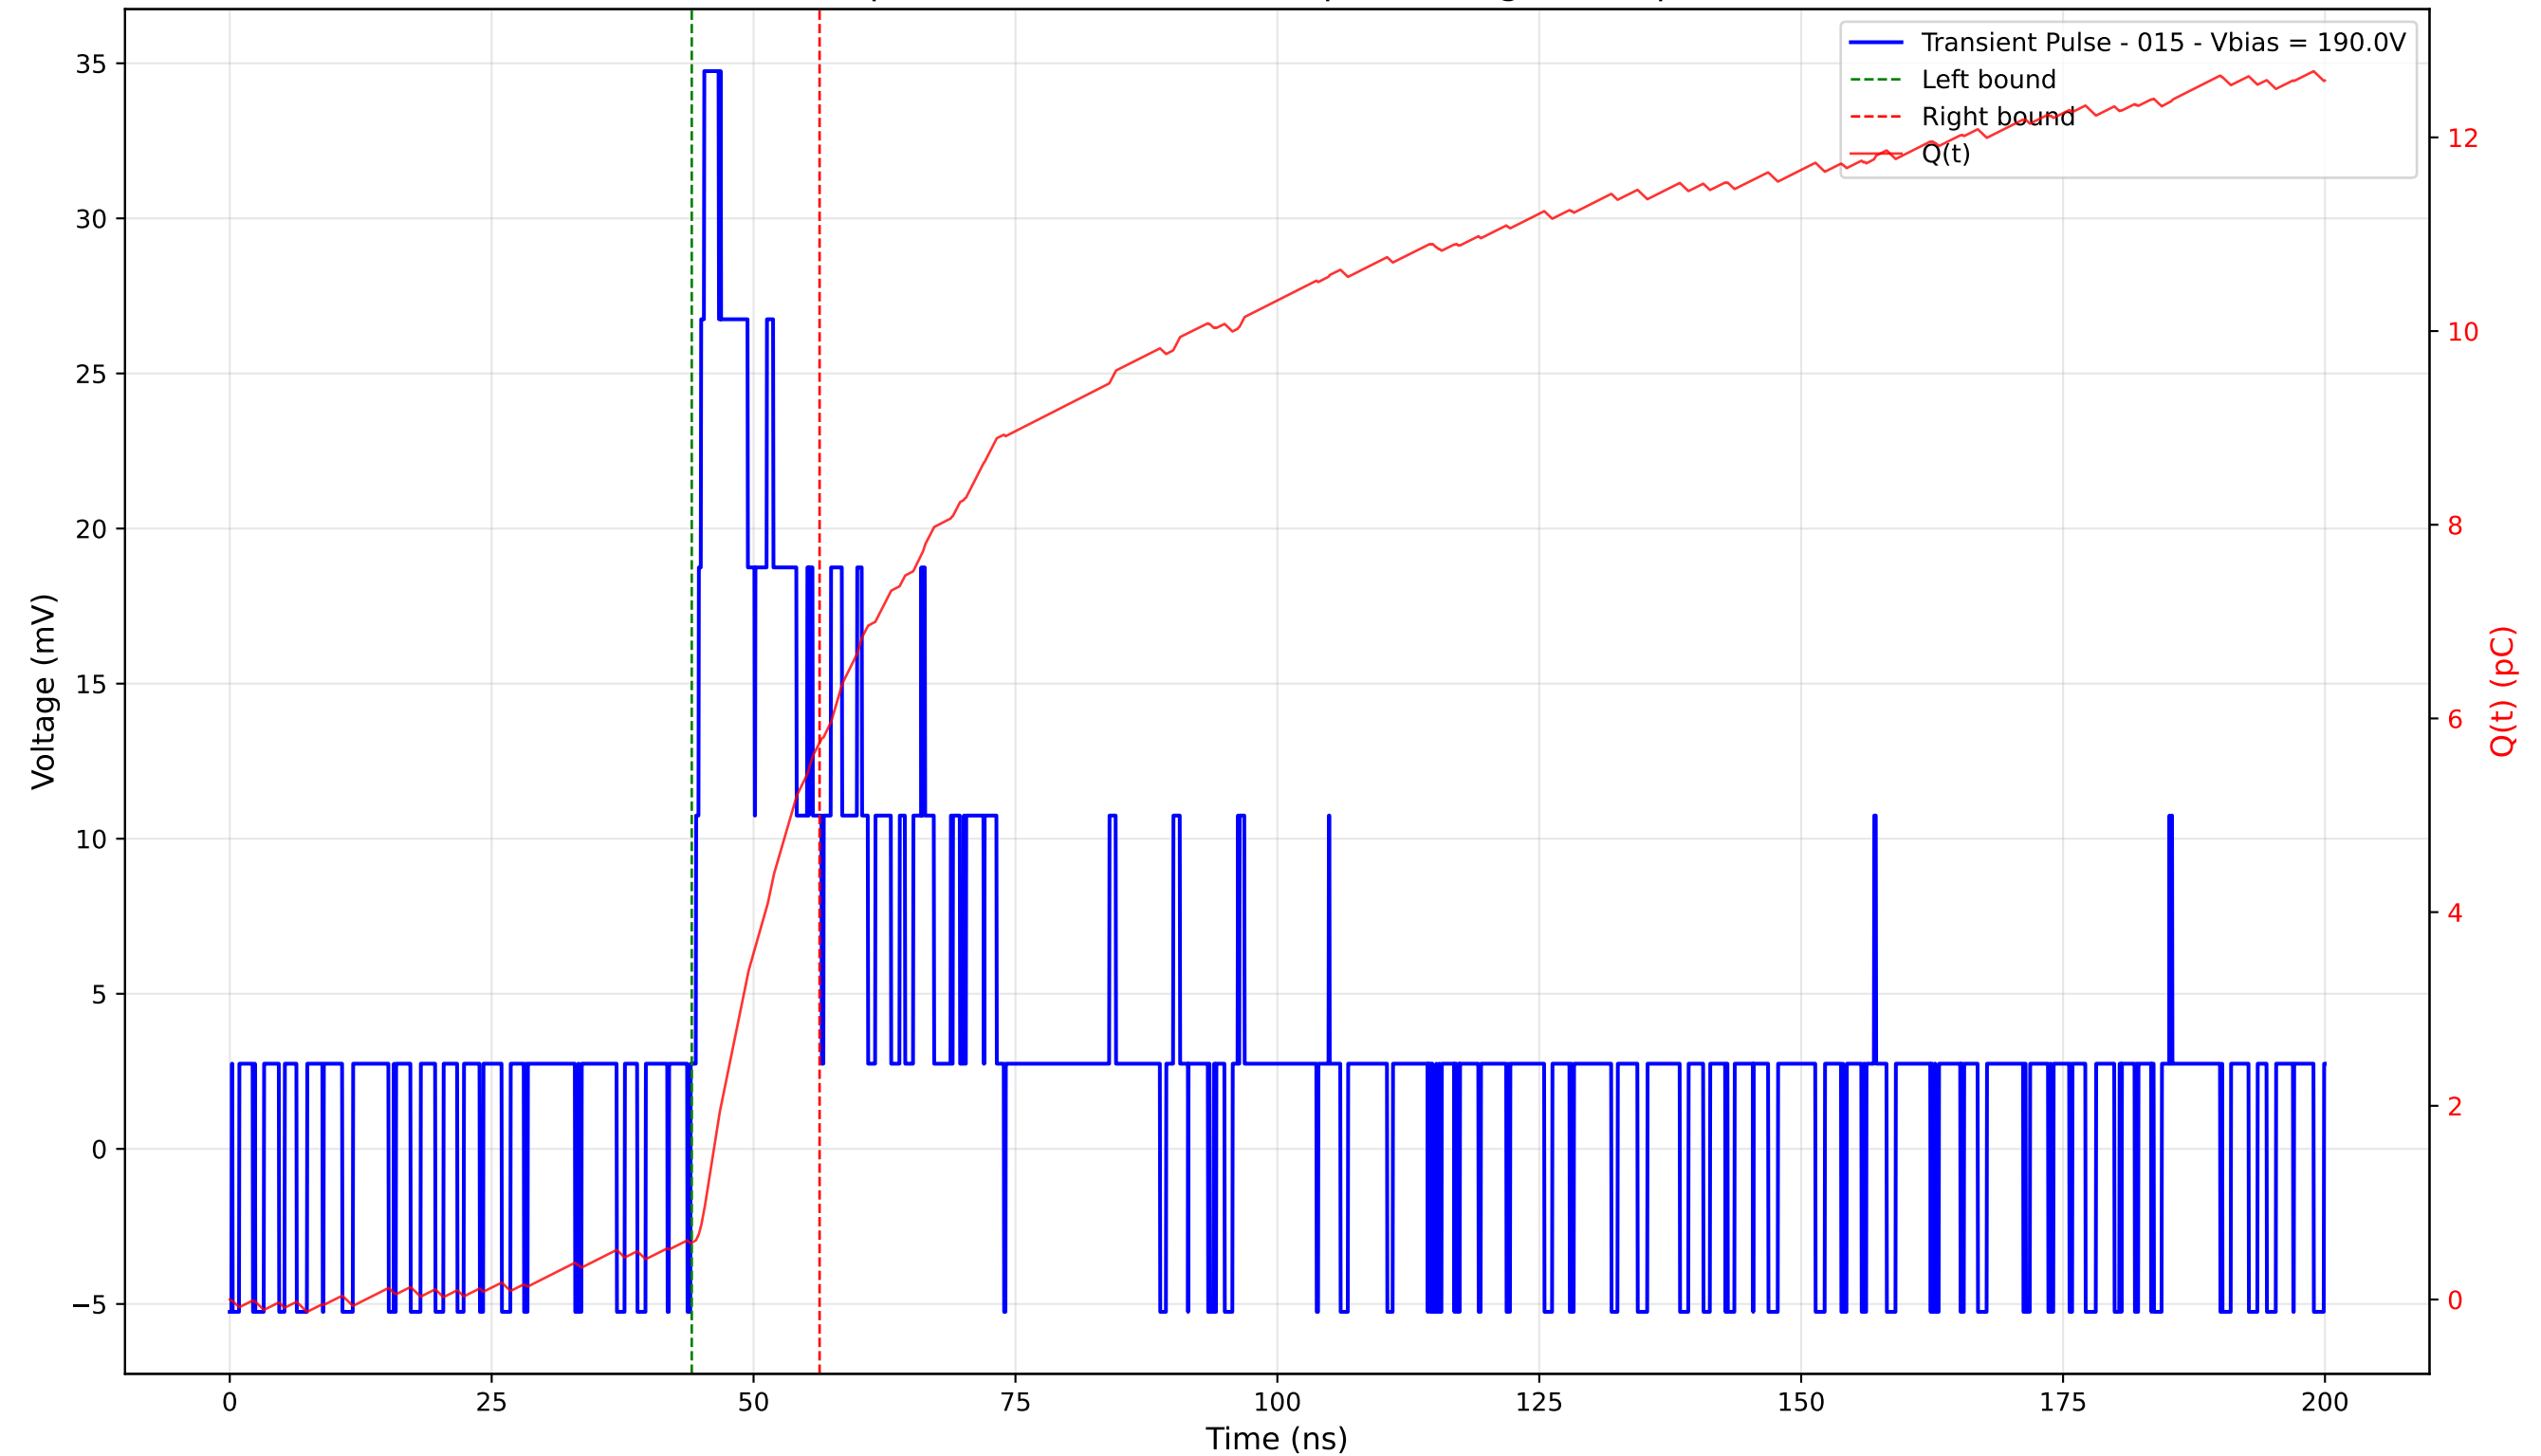


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 1.40 pC - Rise Time: 0.92 ns

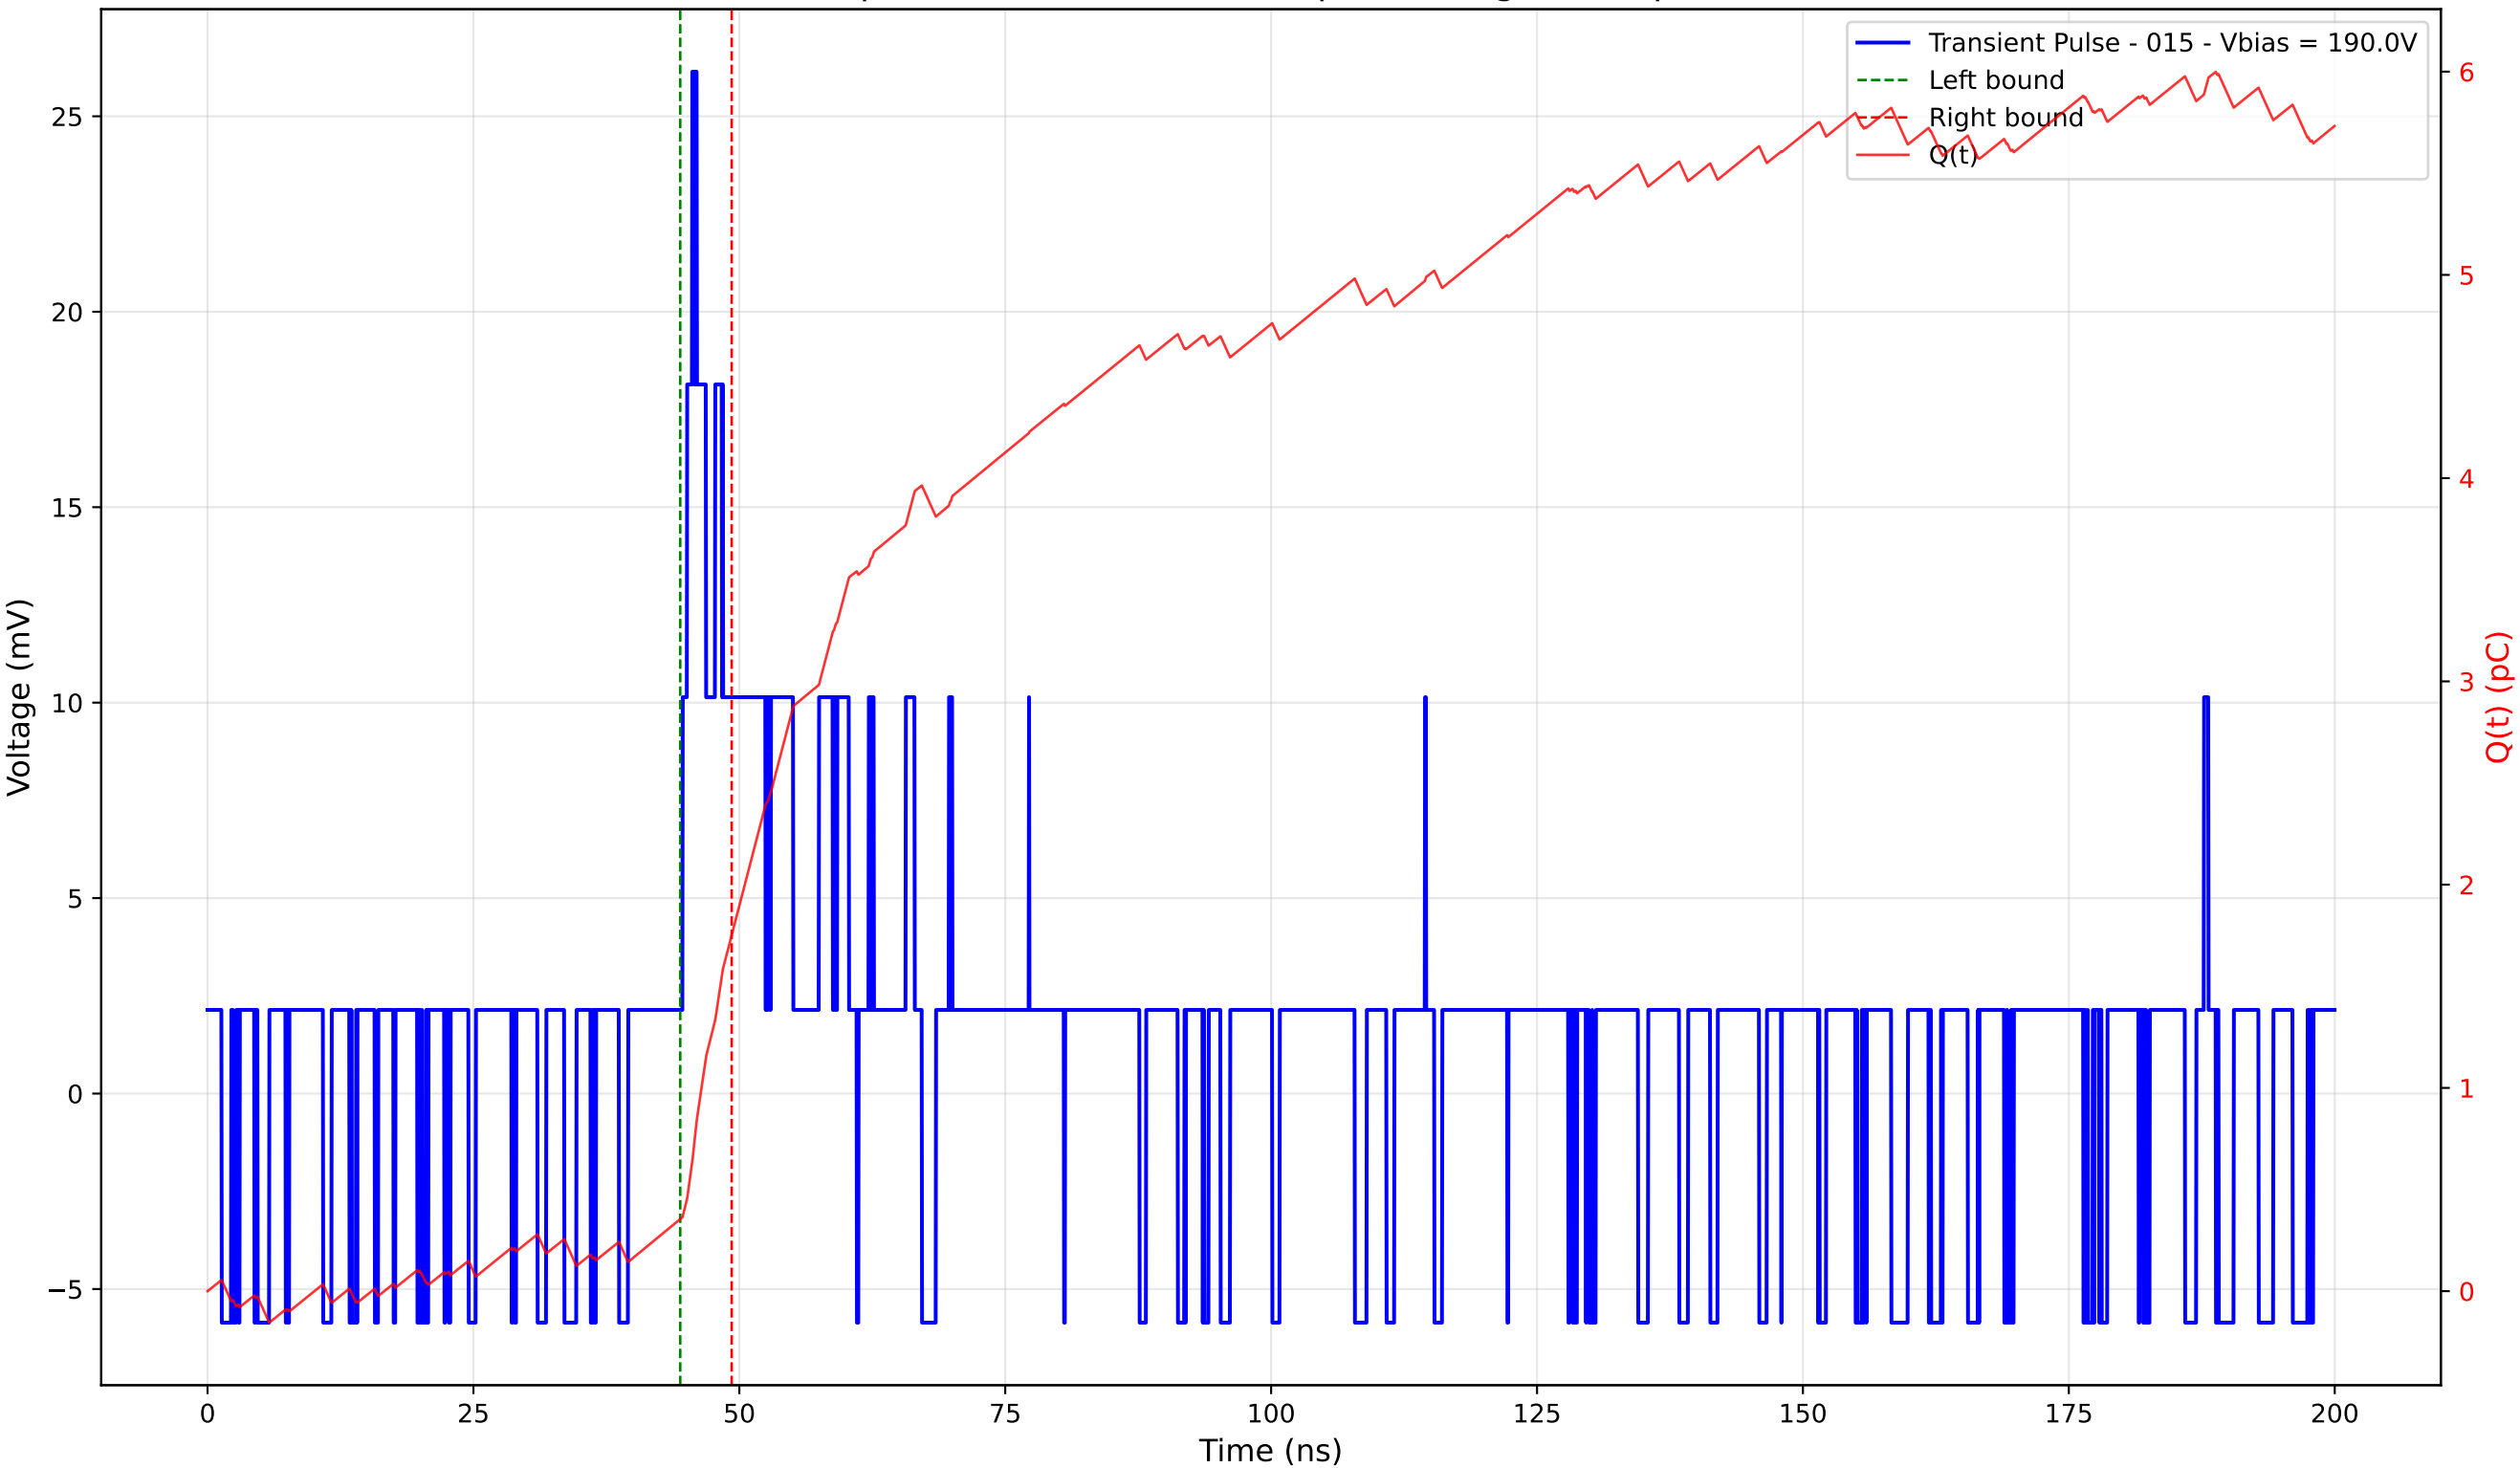


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 1.74 pC - Rise Time: 0.32 ns




Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 2.20 pC - Rise Time: 0.00 ns (N/A)

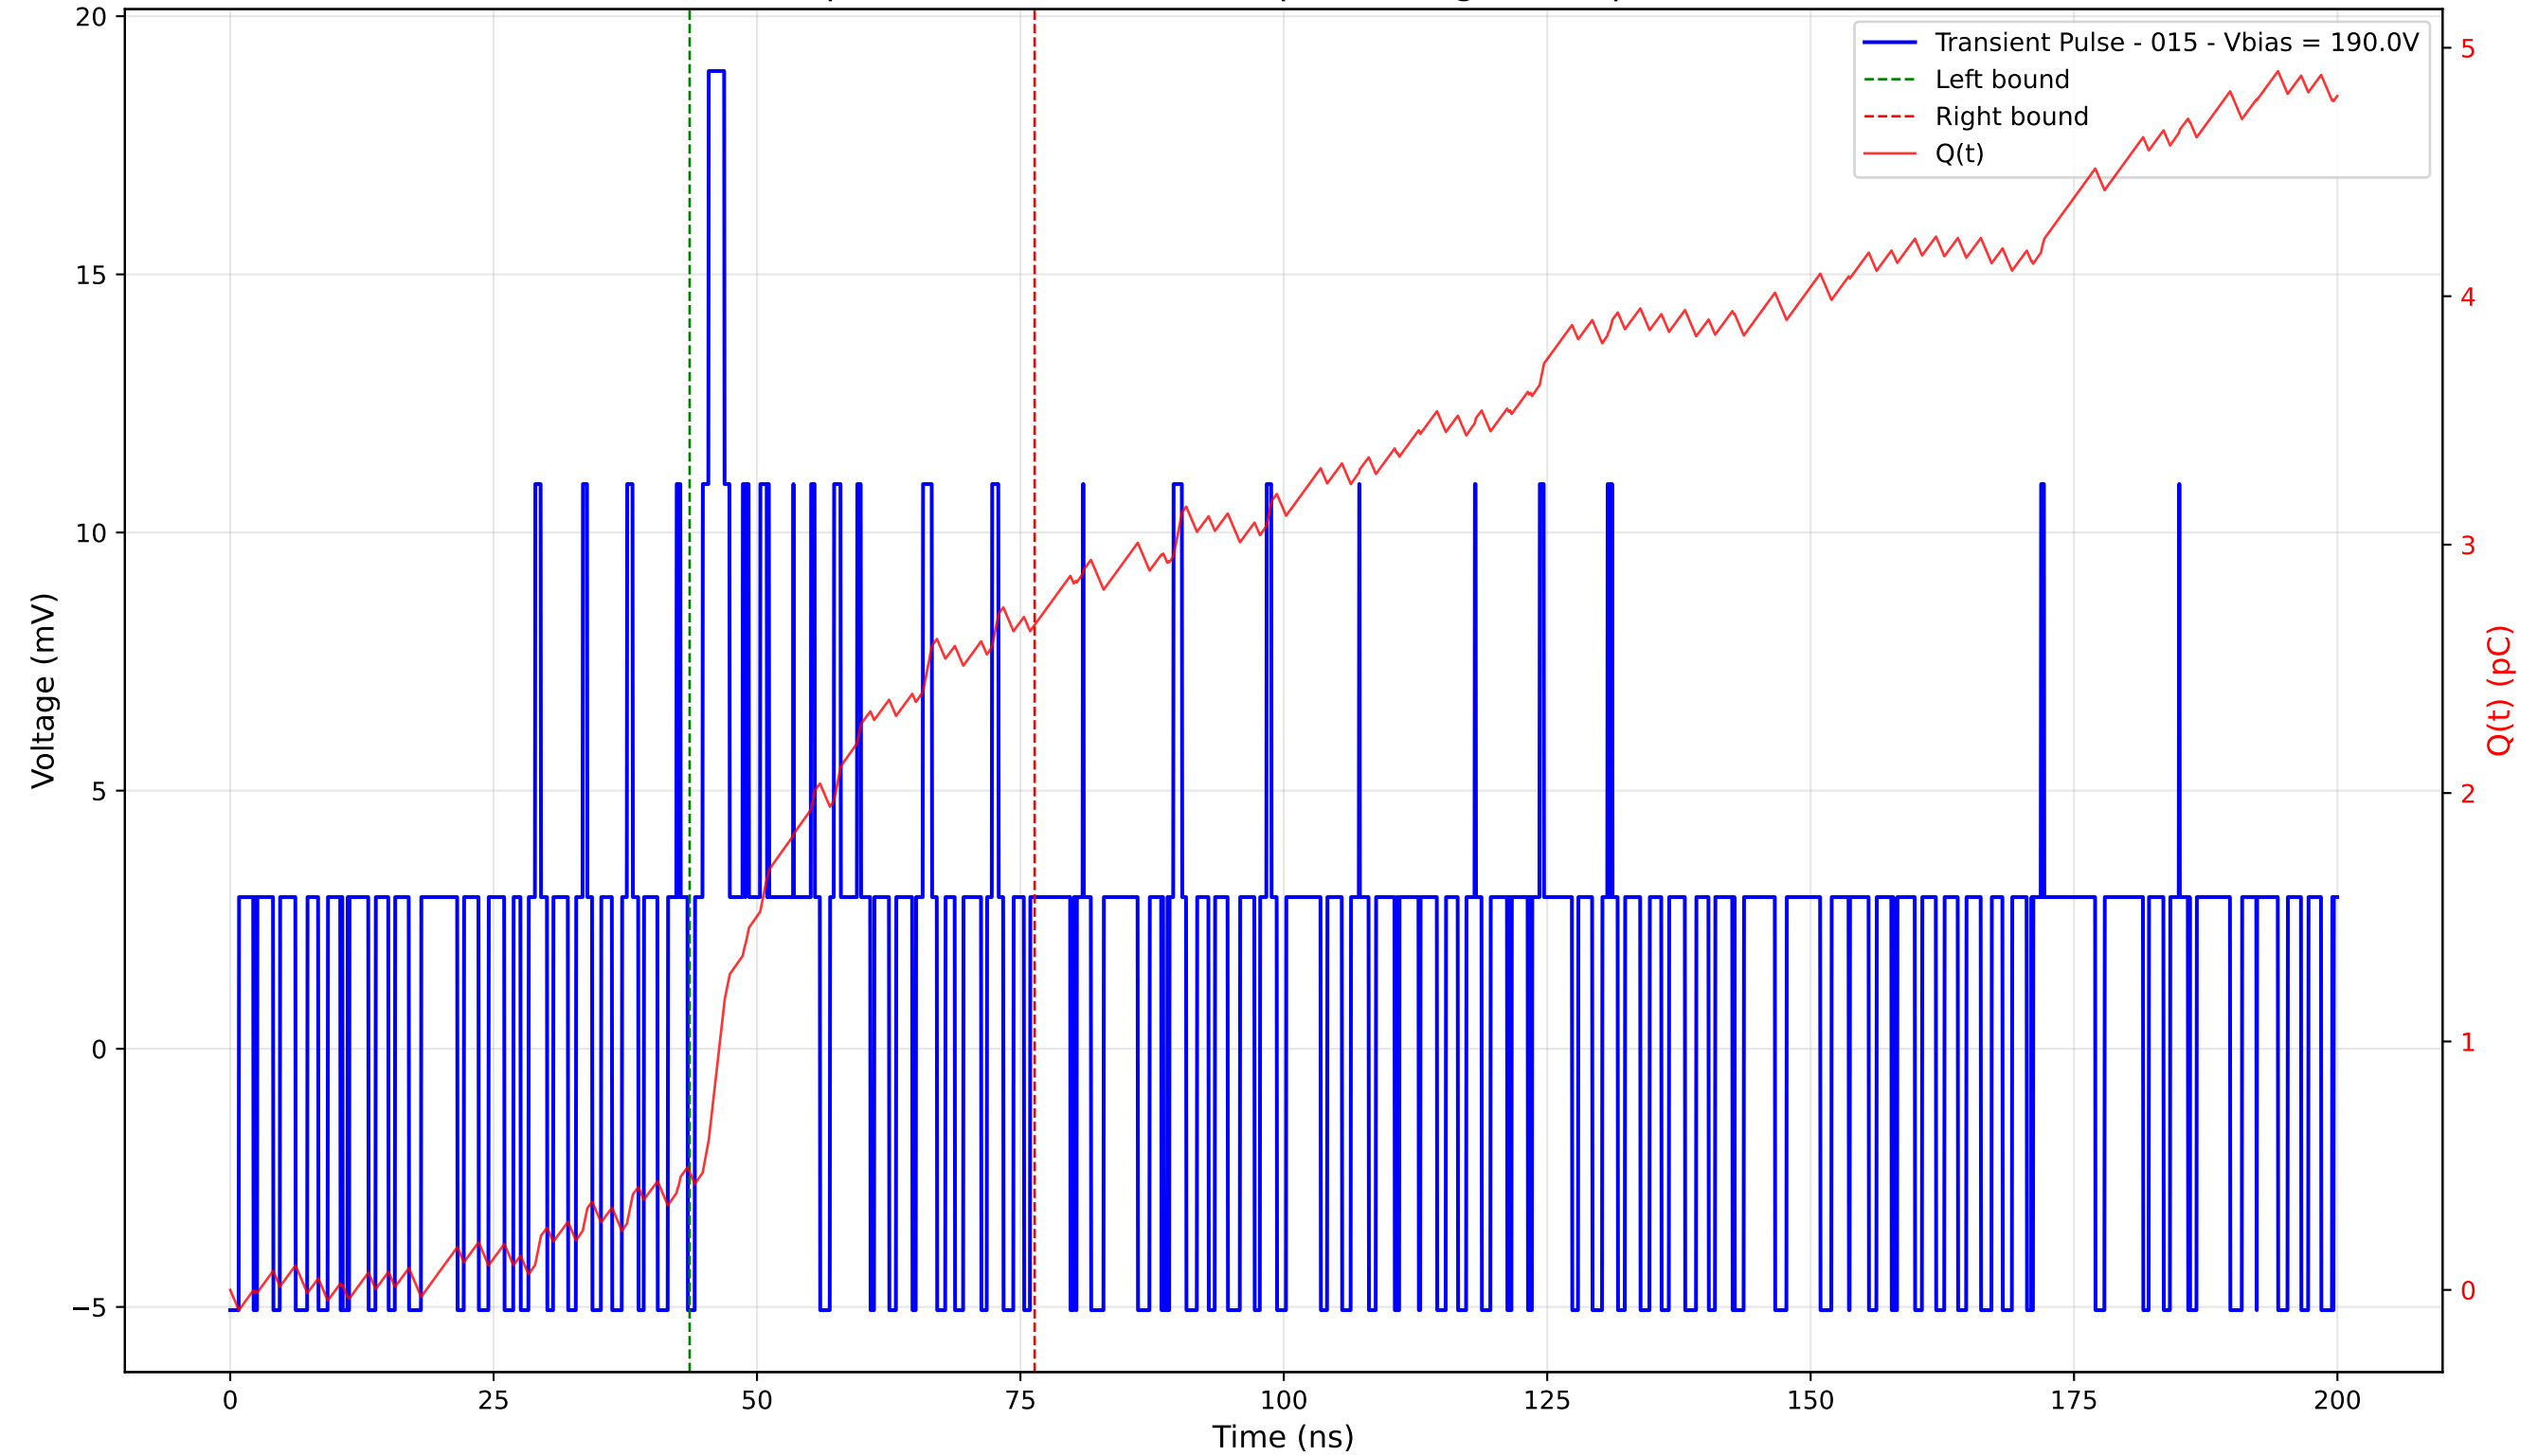


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.07 pC - Rise Time: 0.00 ns (N/A)

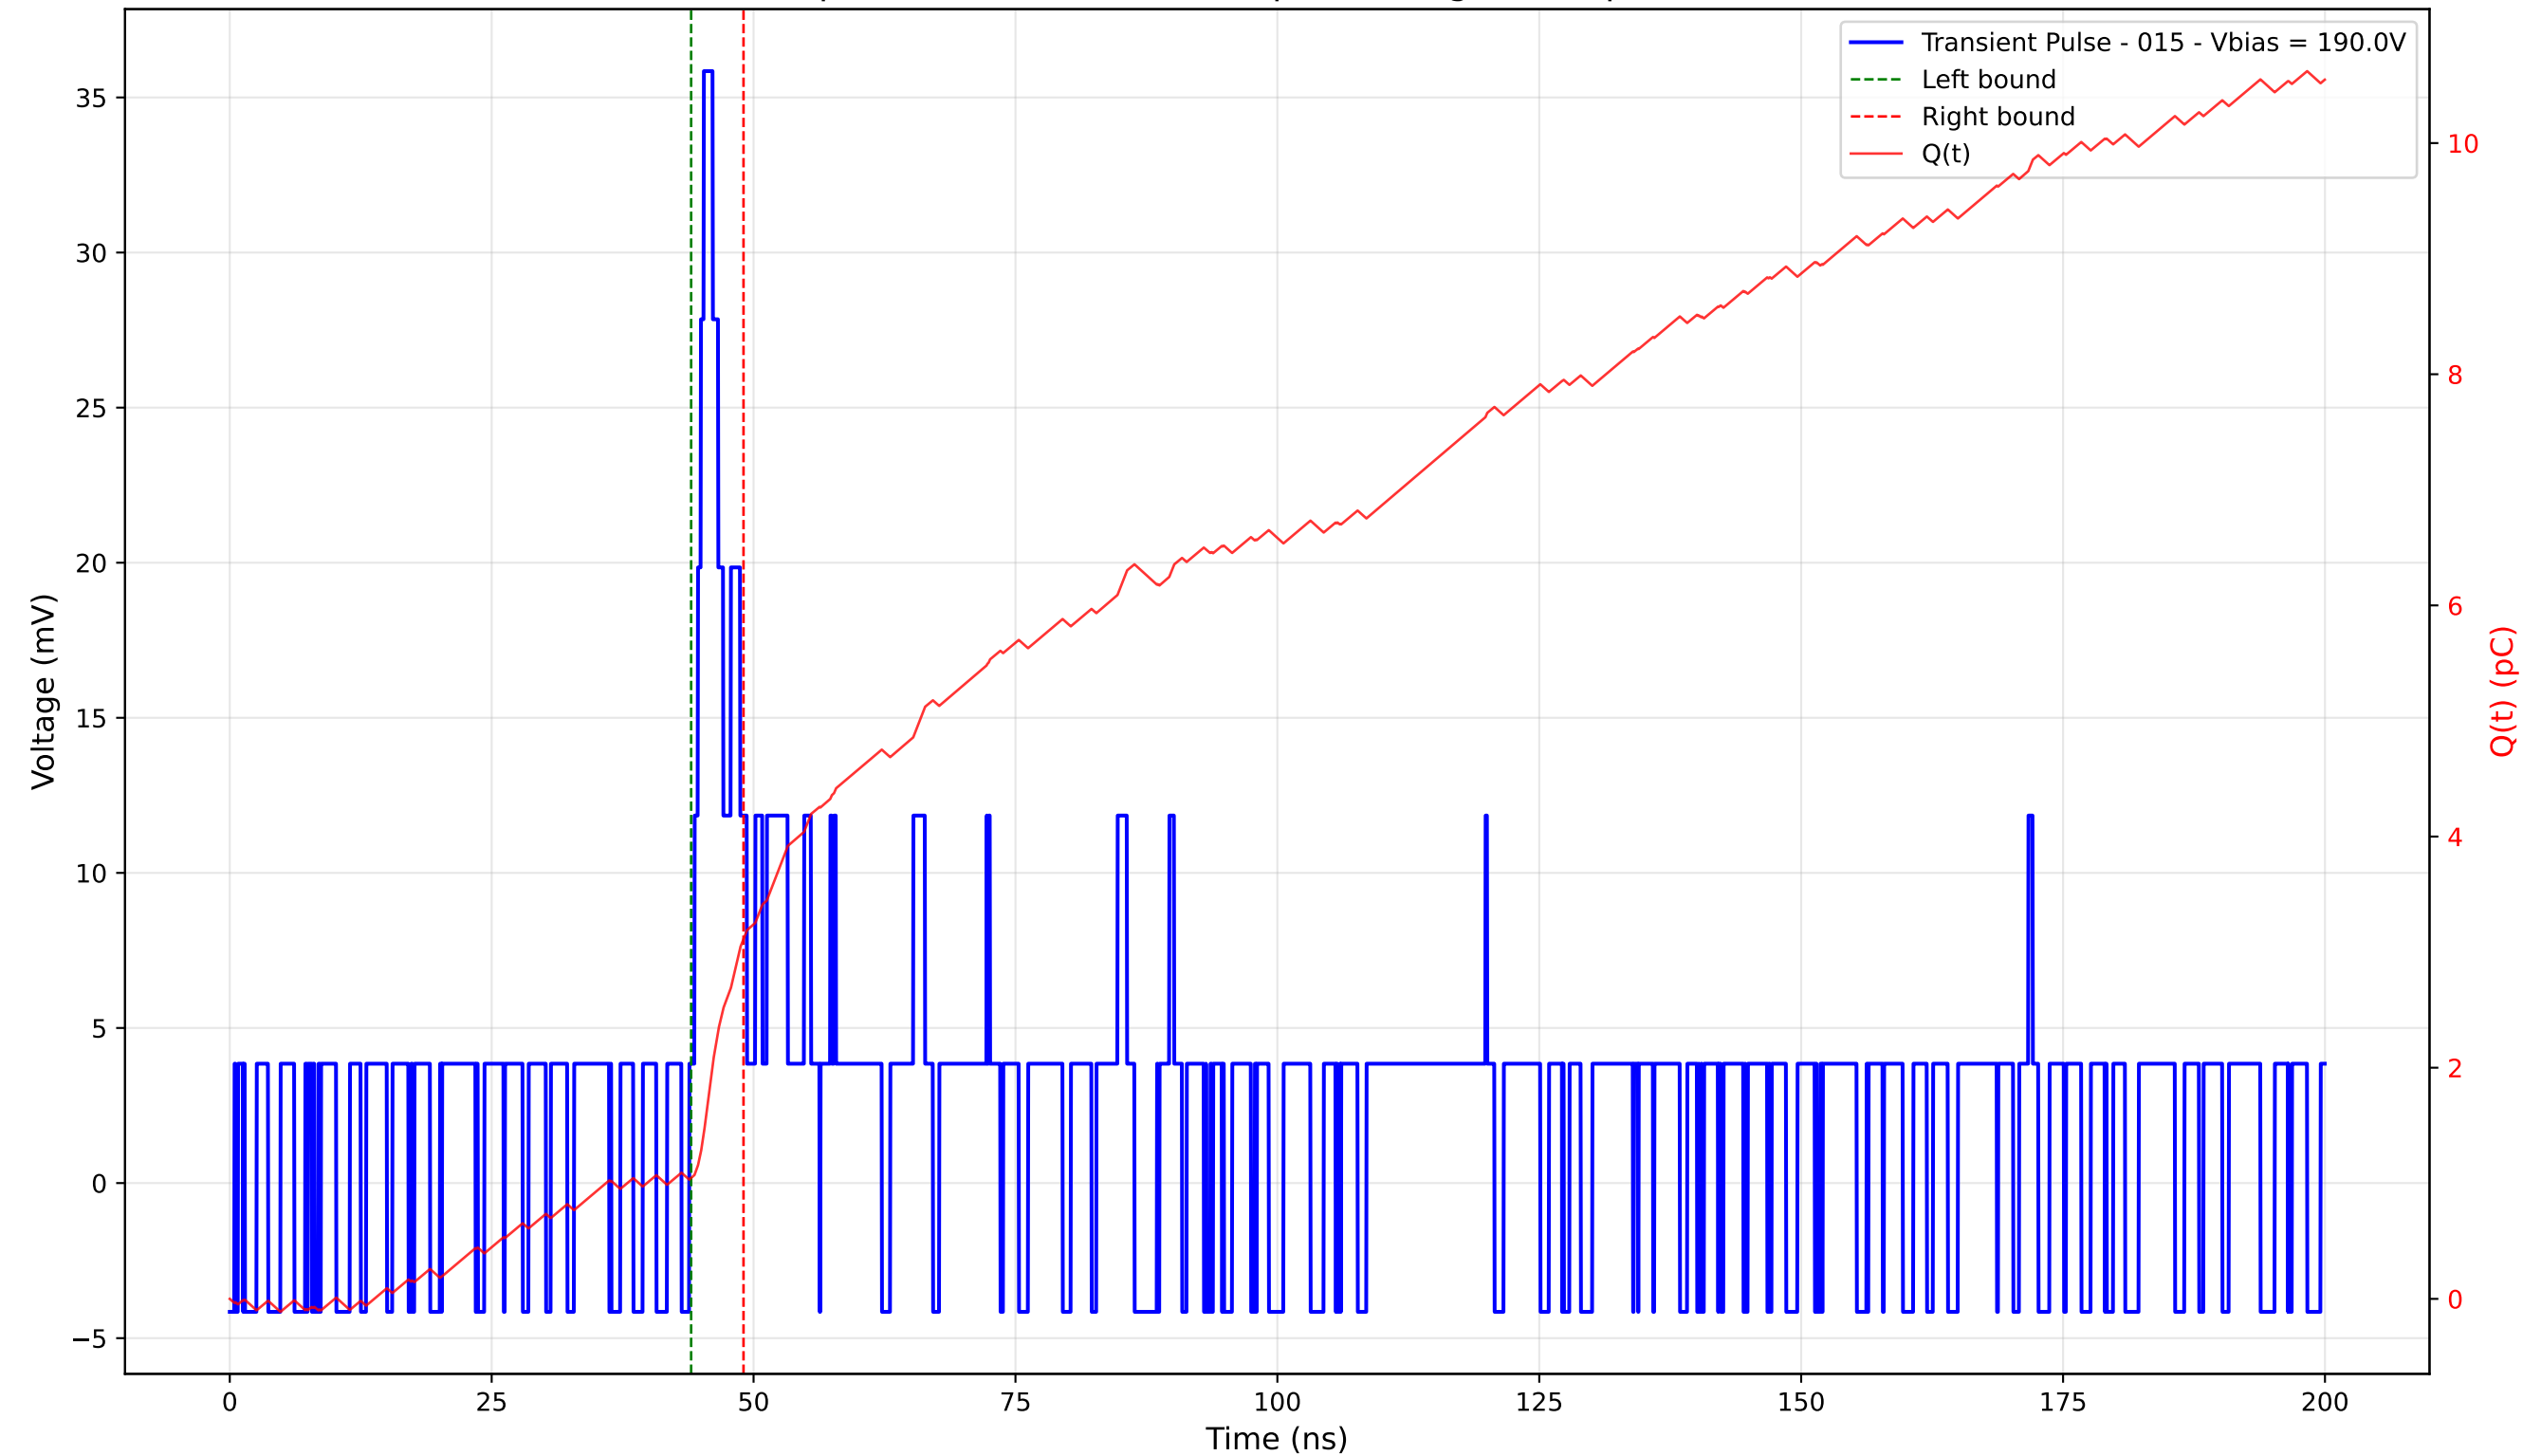


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 4.42 pC - Rise Time: 1.01 ns

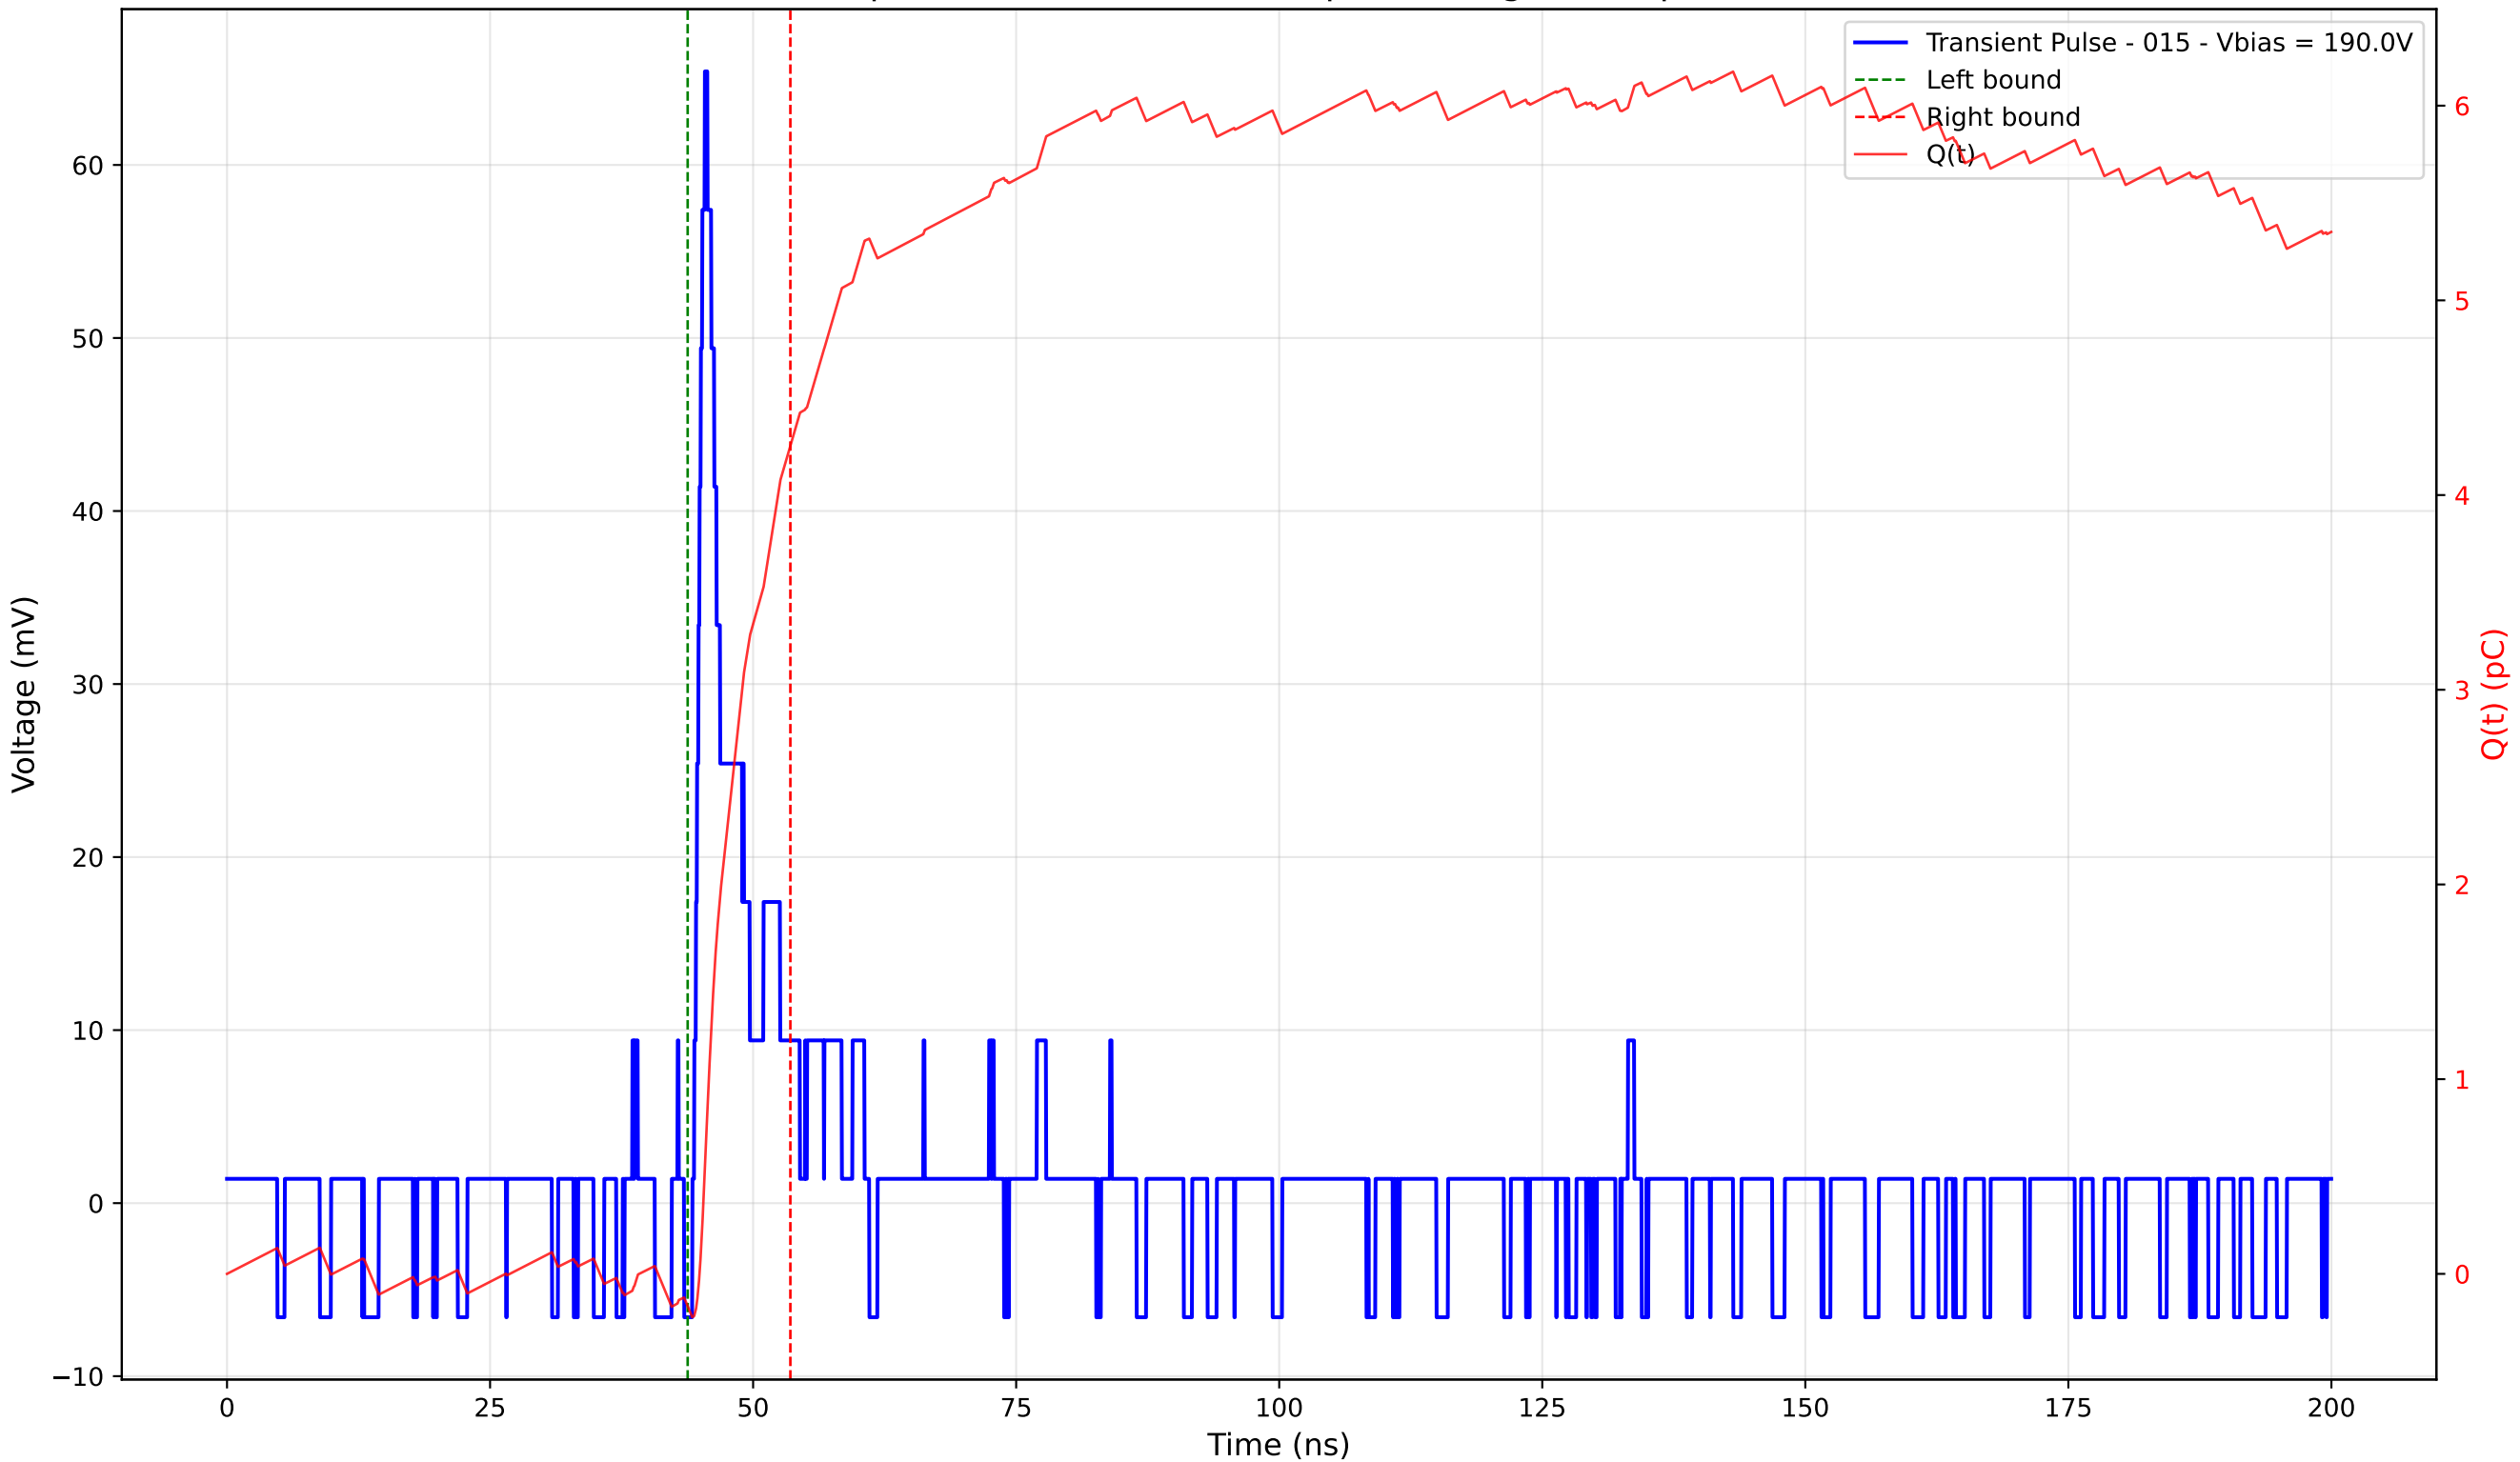


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 10.06 pC - Rise Time: 0.95 ns

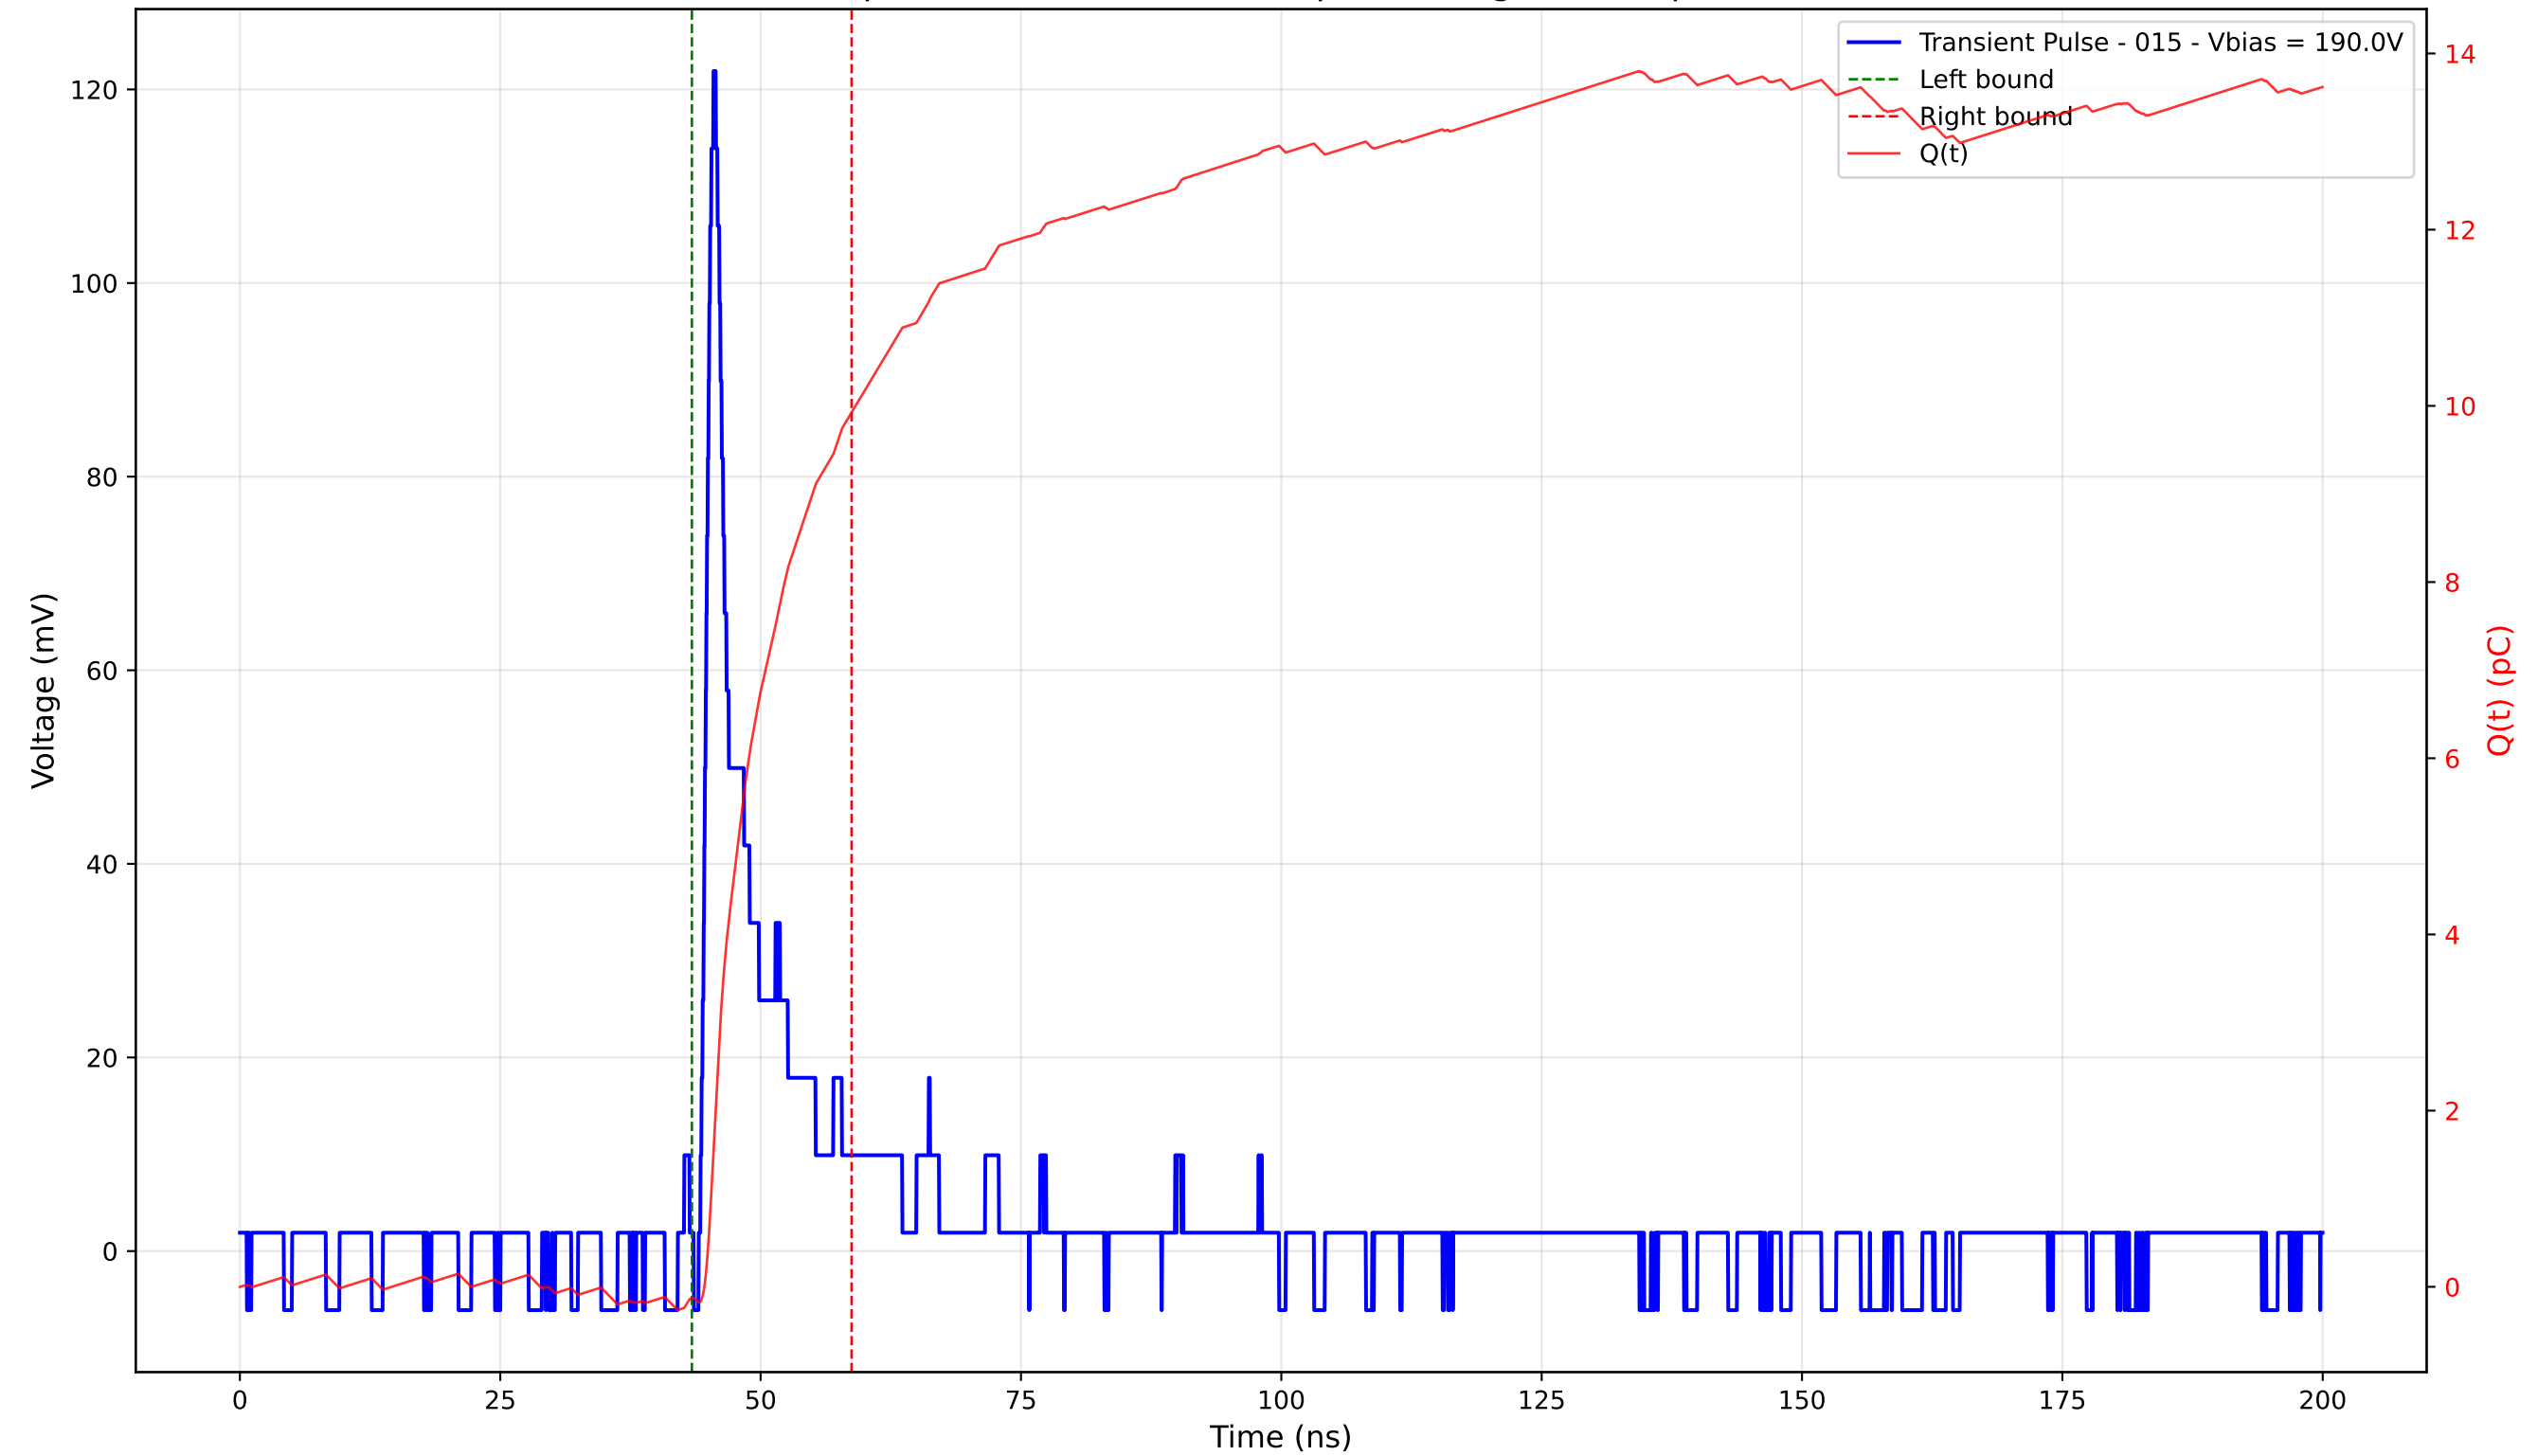


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 16.30 pC - Rise Time: 0.91 ns

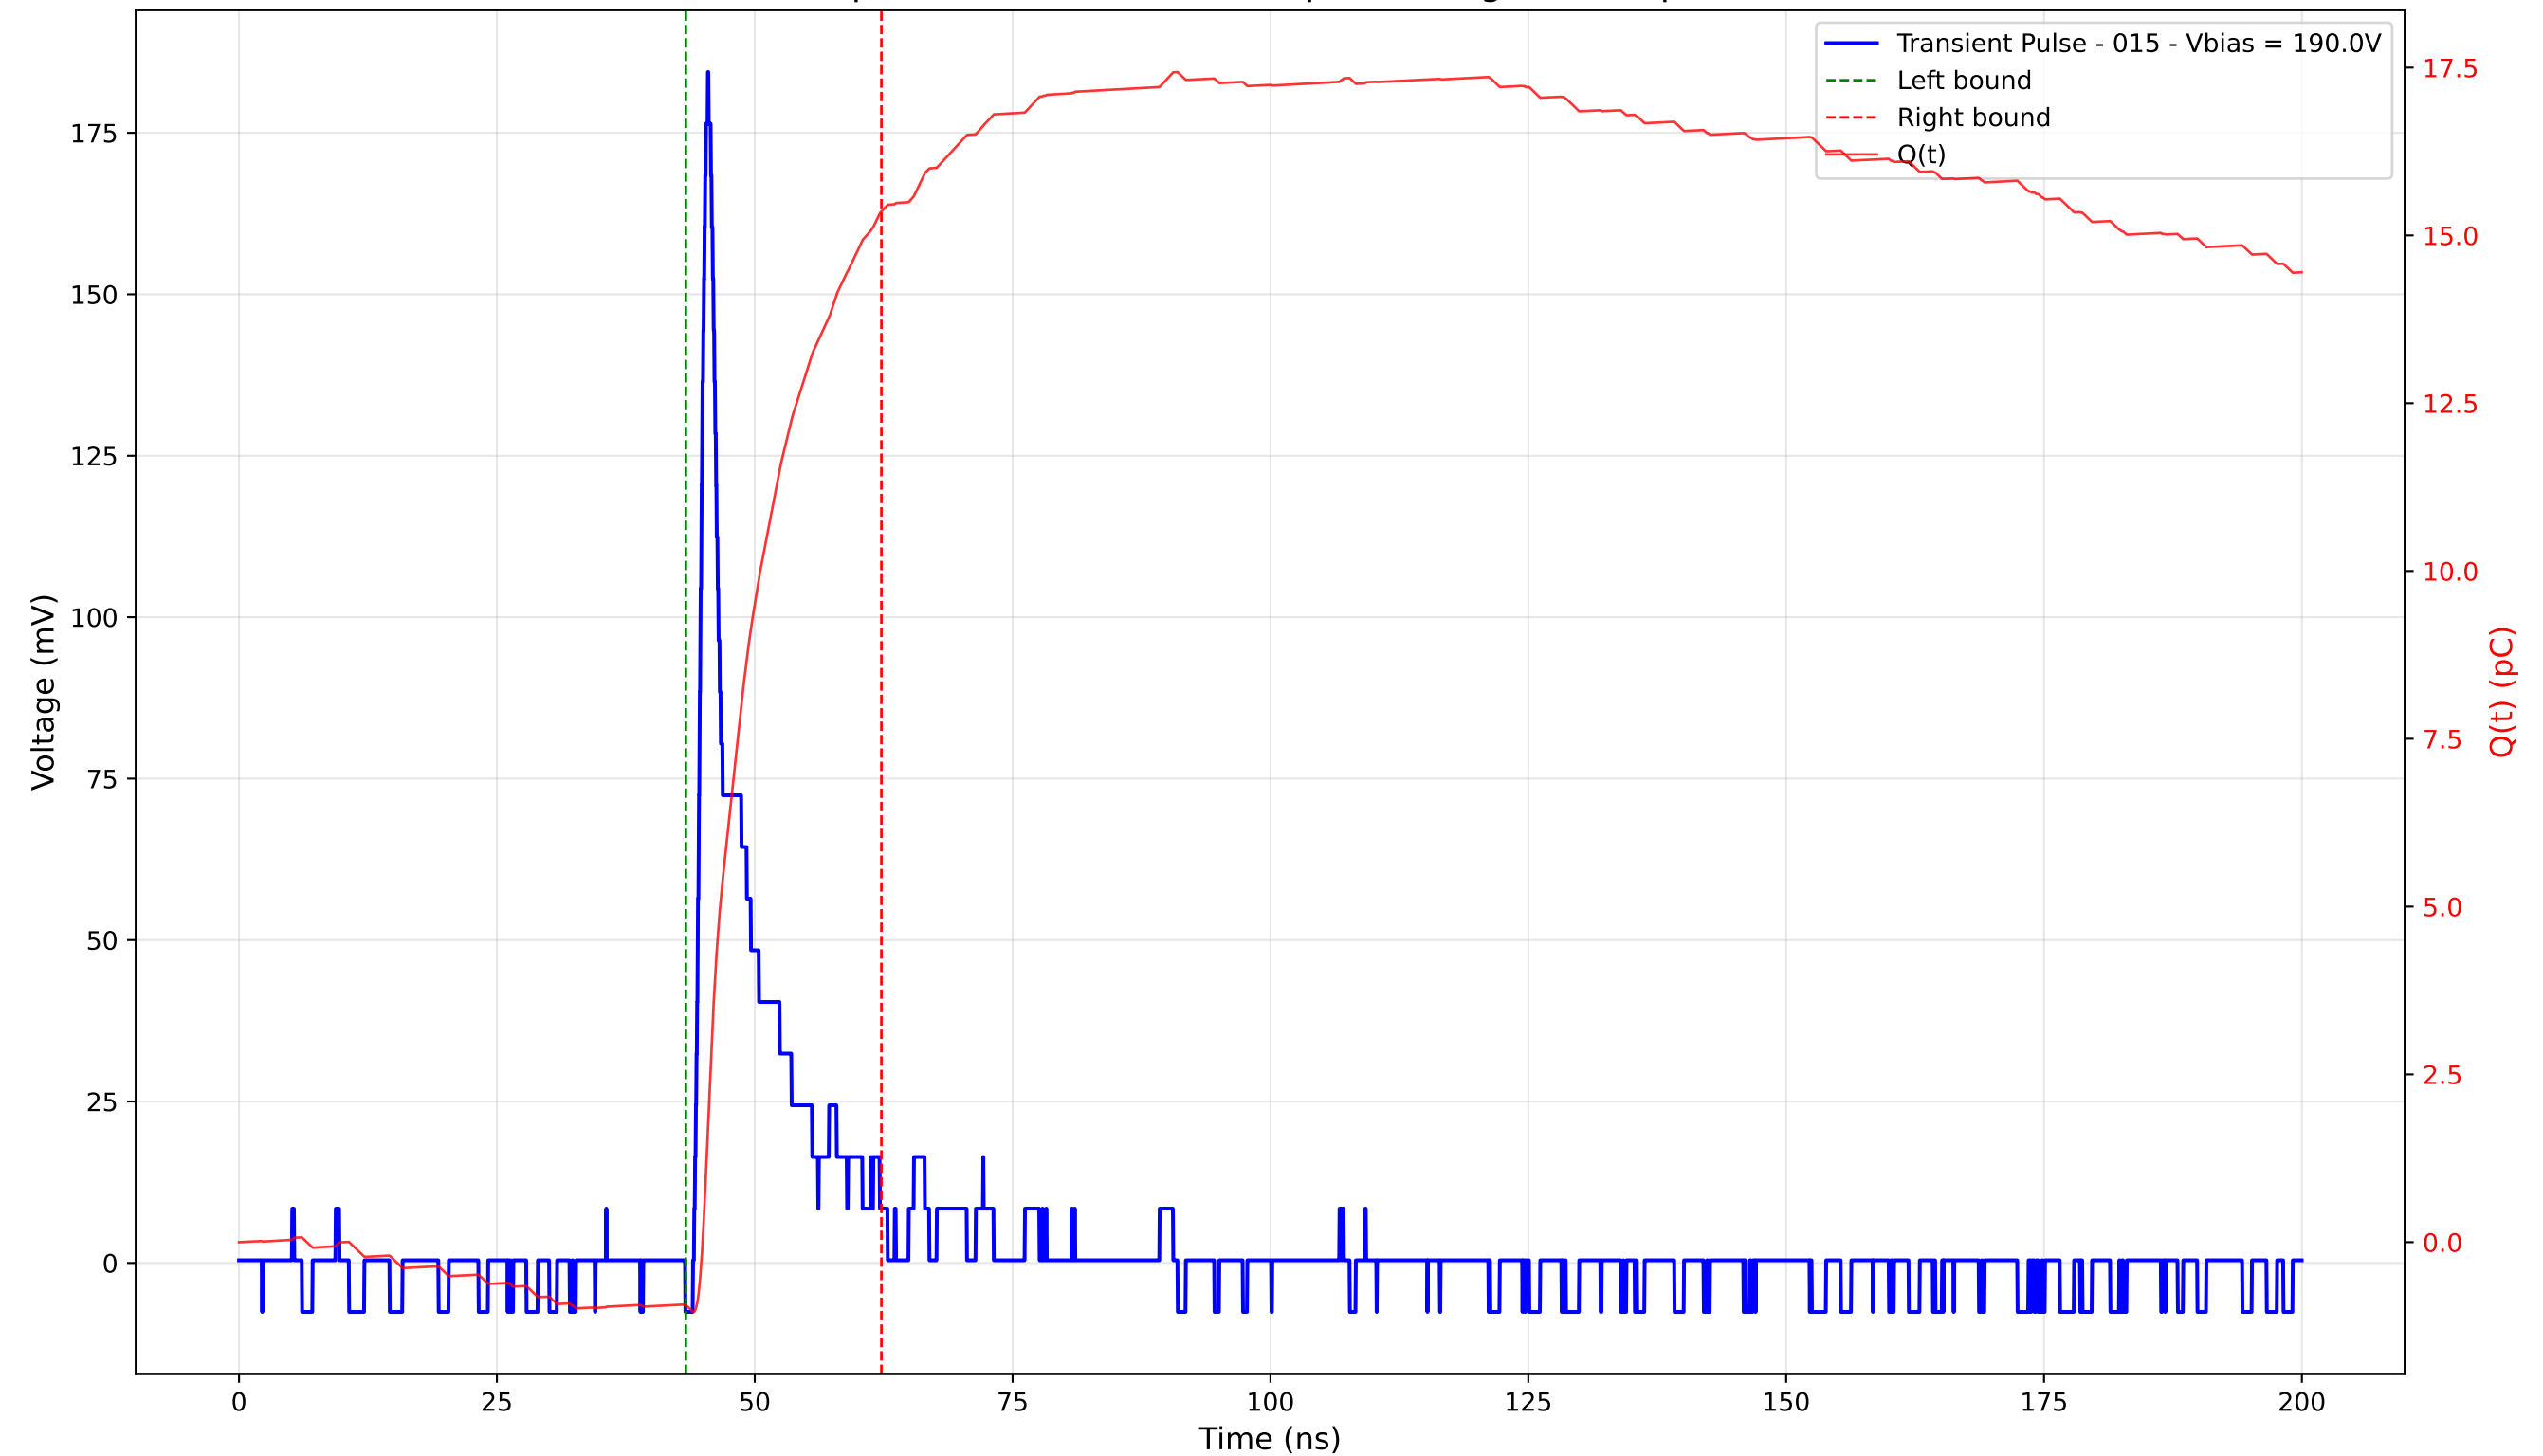


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 23.43 pC - Rise Time: 0.90 ns

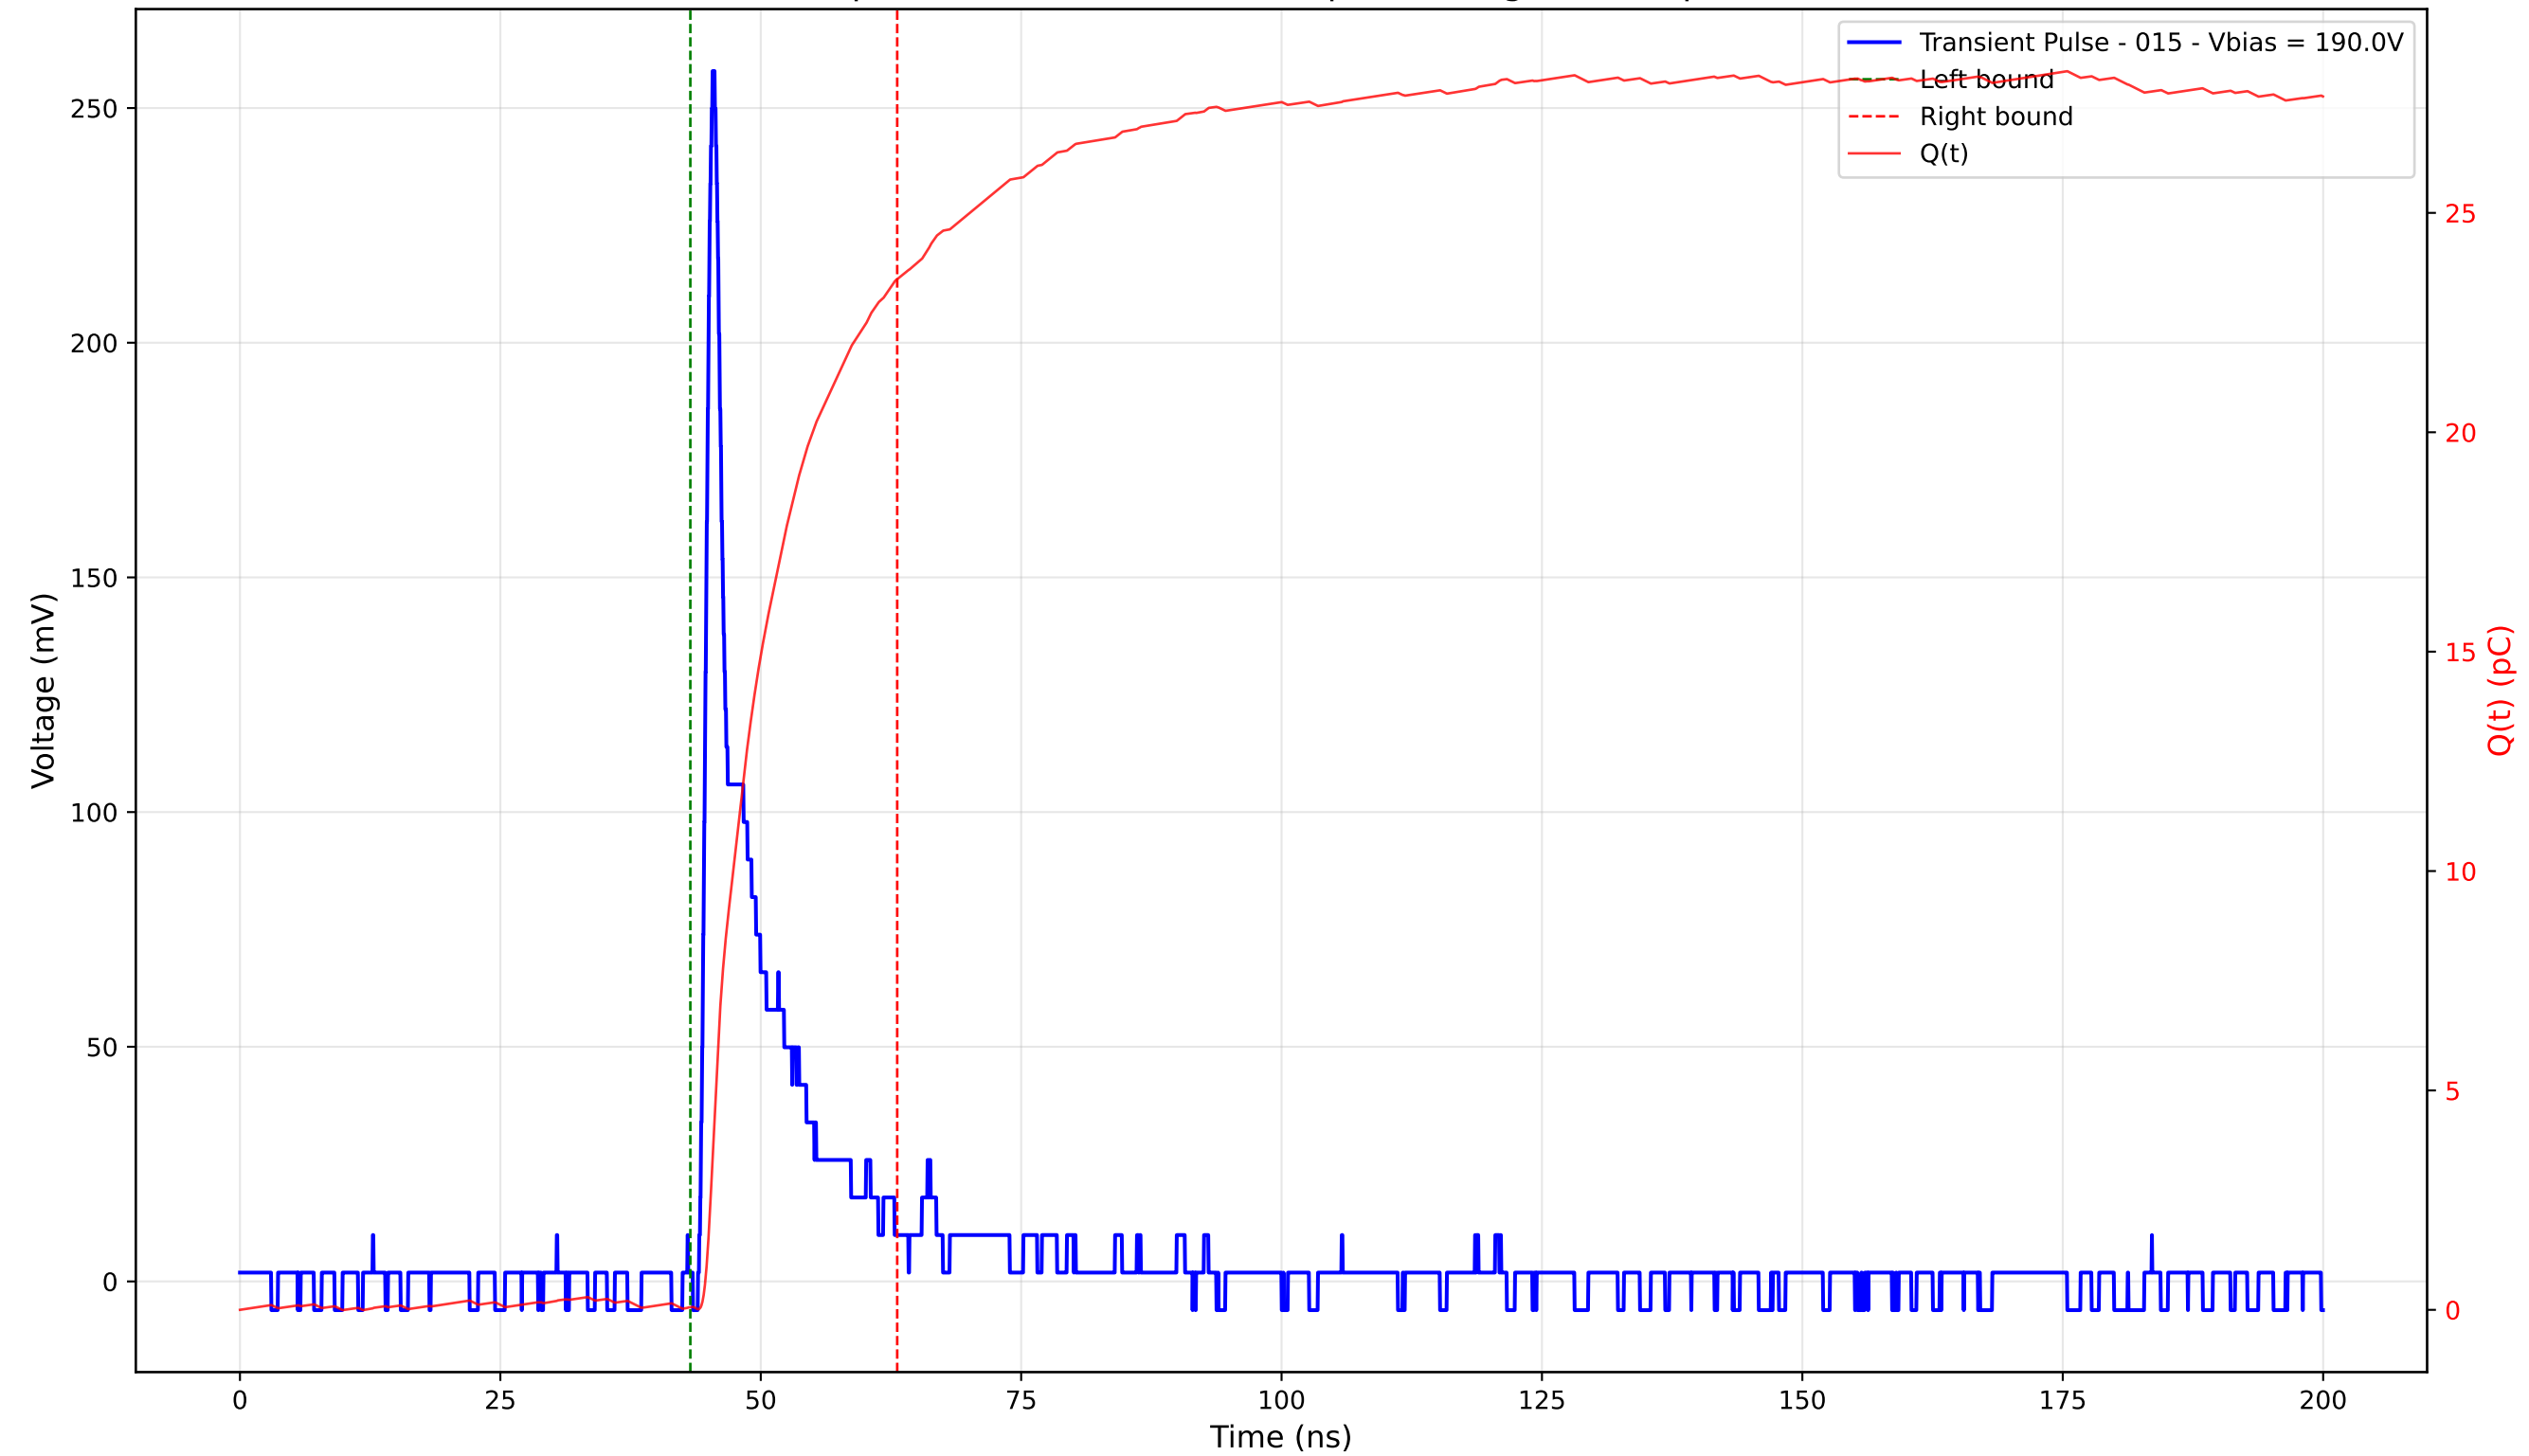


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 30.33 pC - Rise Time: 0.89 ns

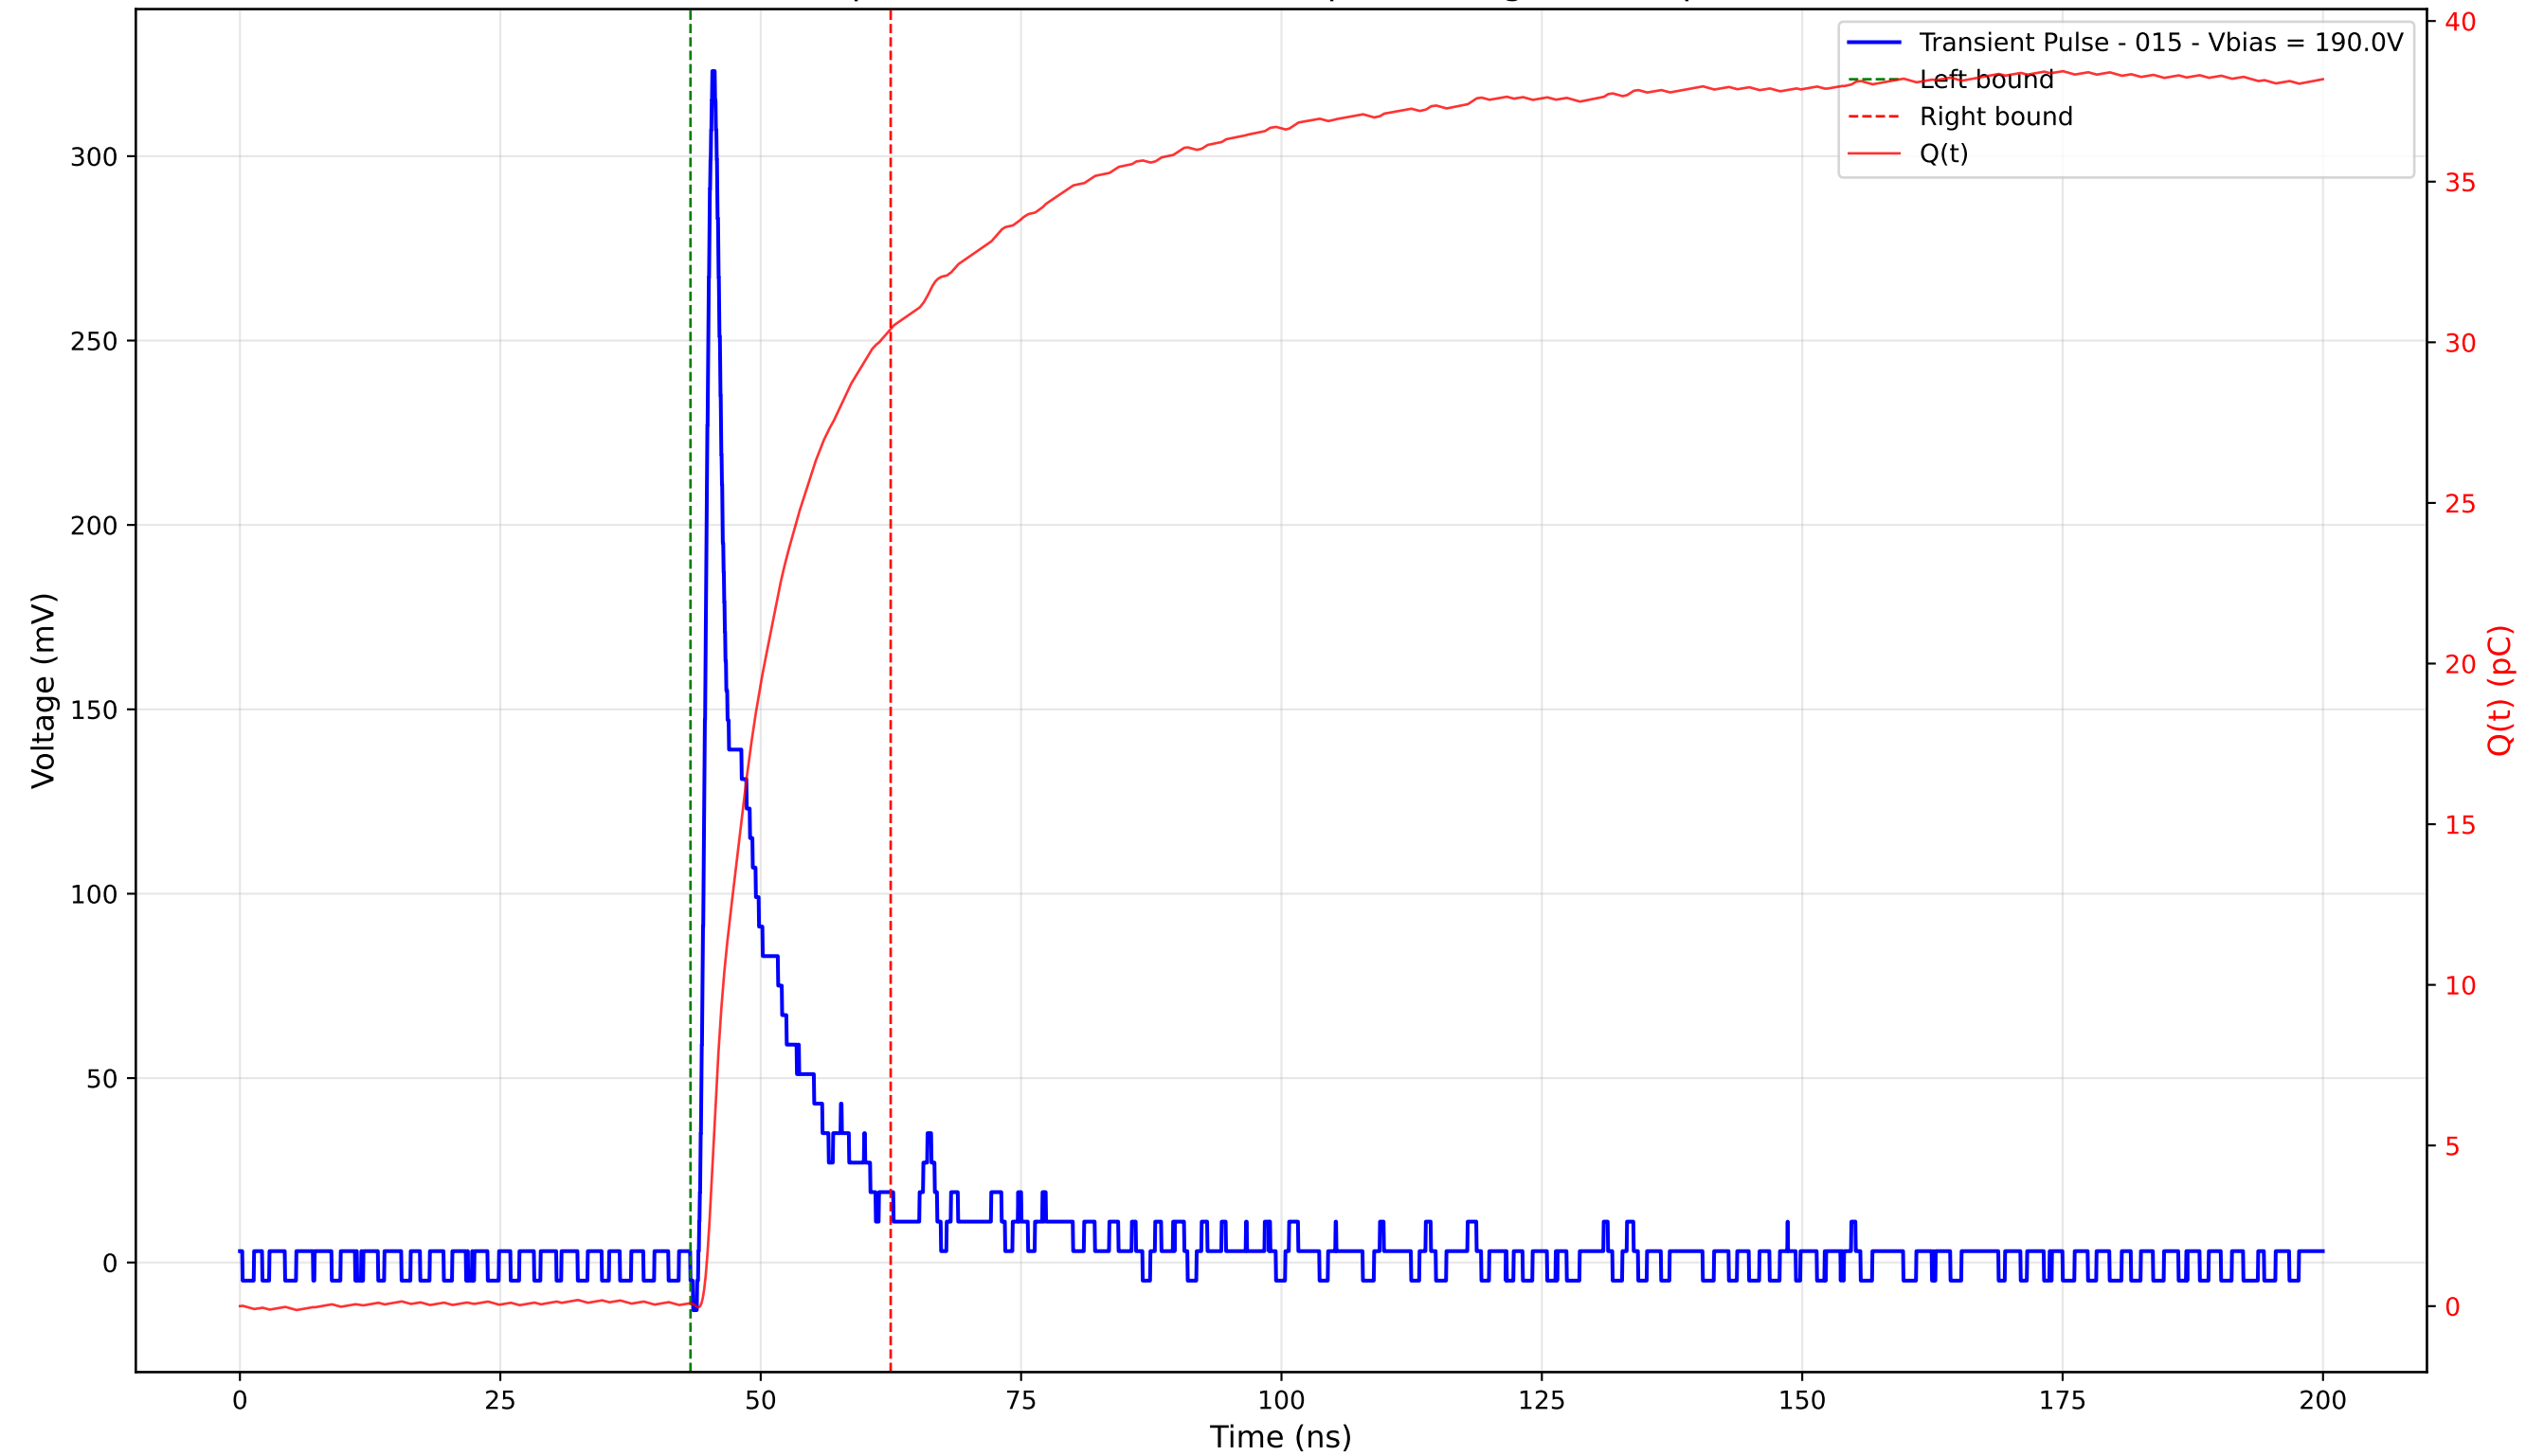


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 37.01 pC - Rise Time: 0.92 ns

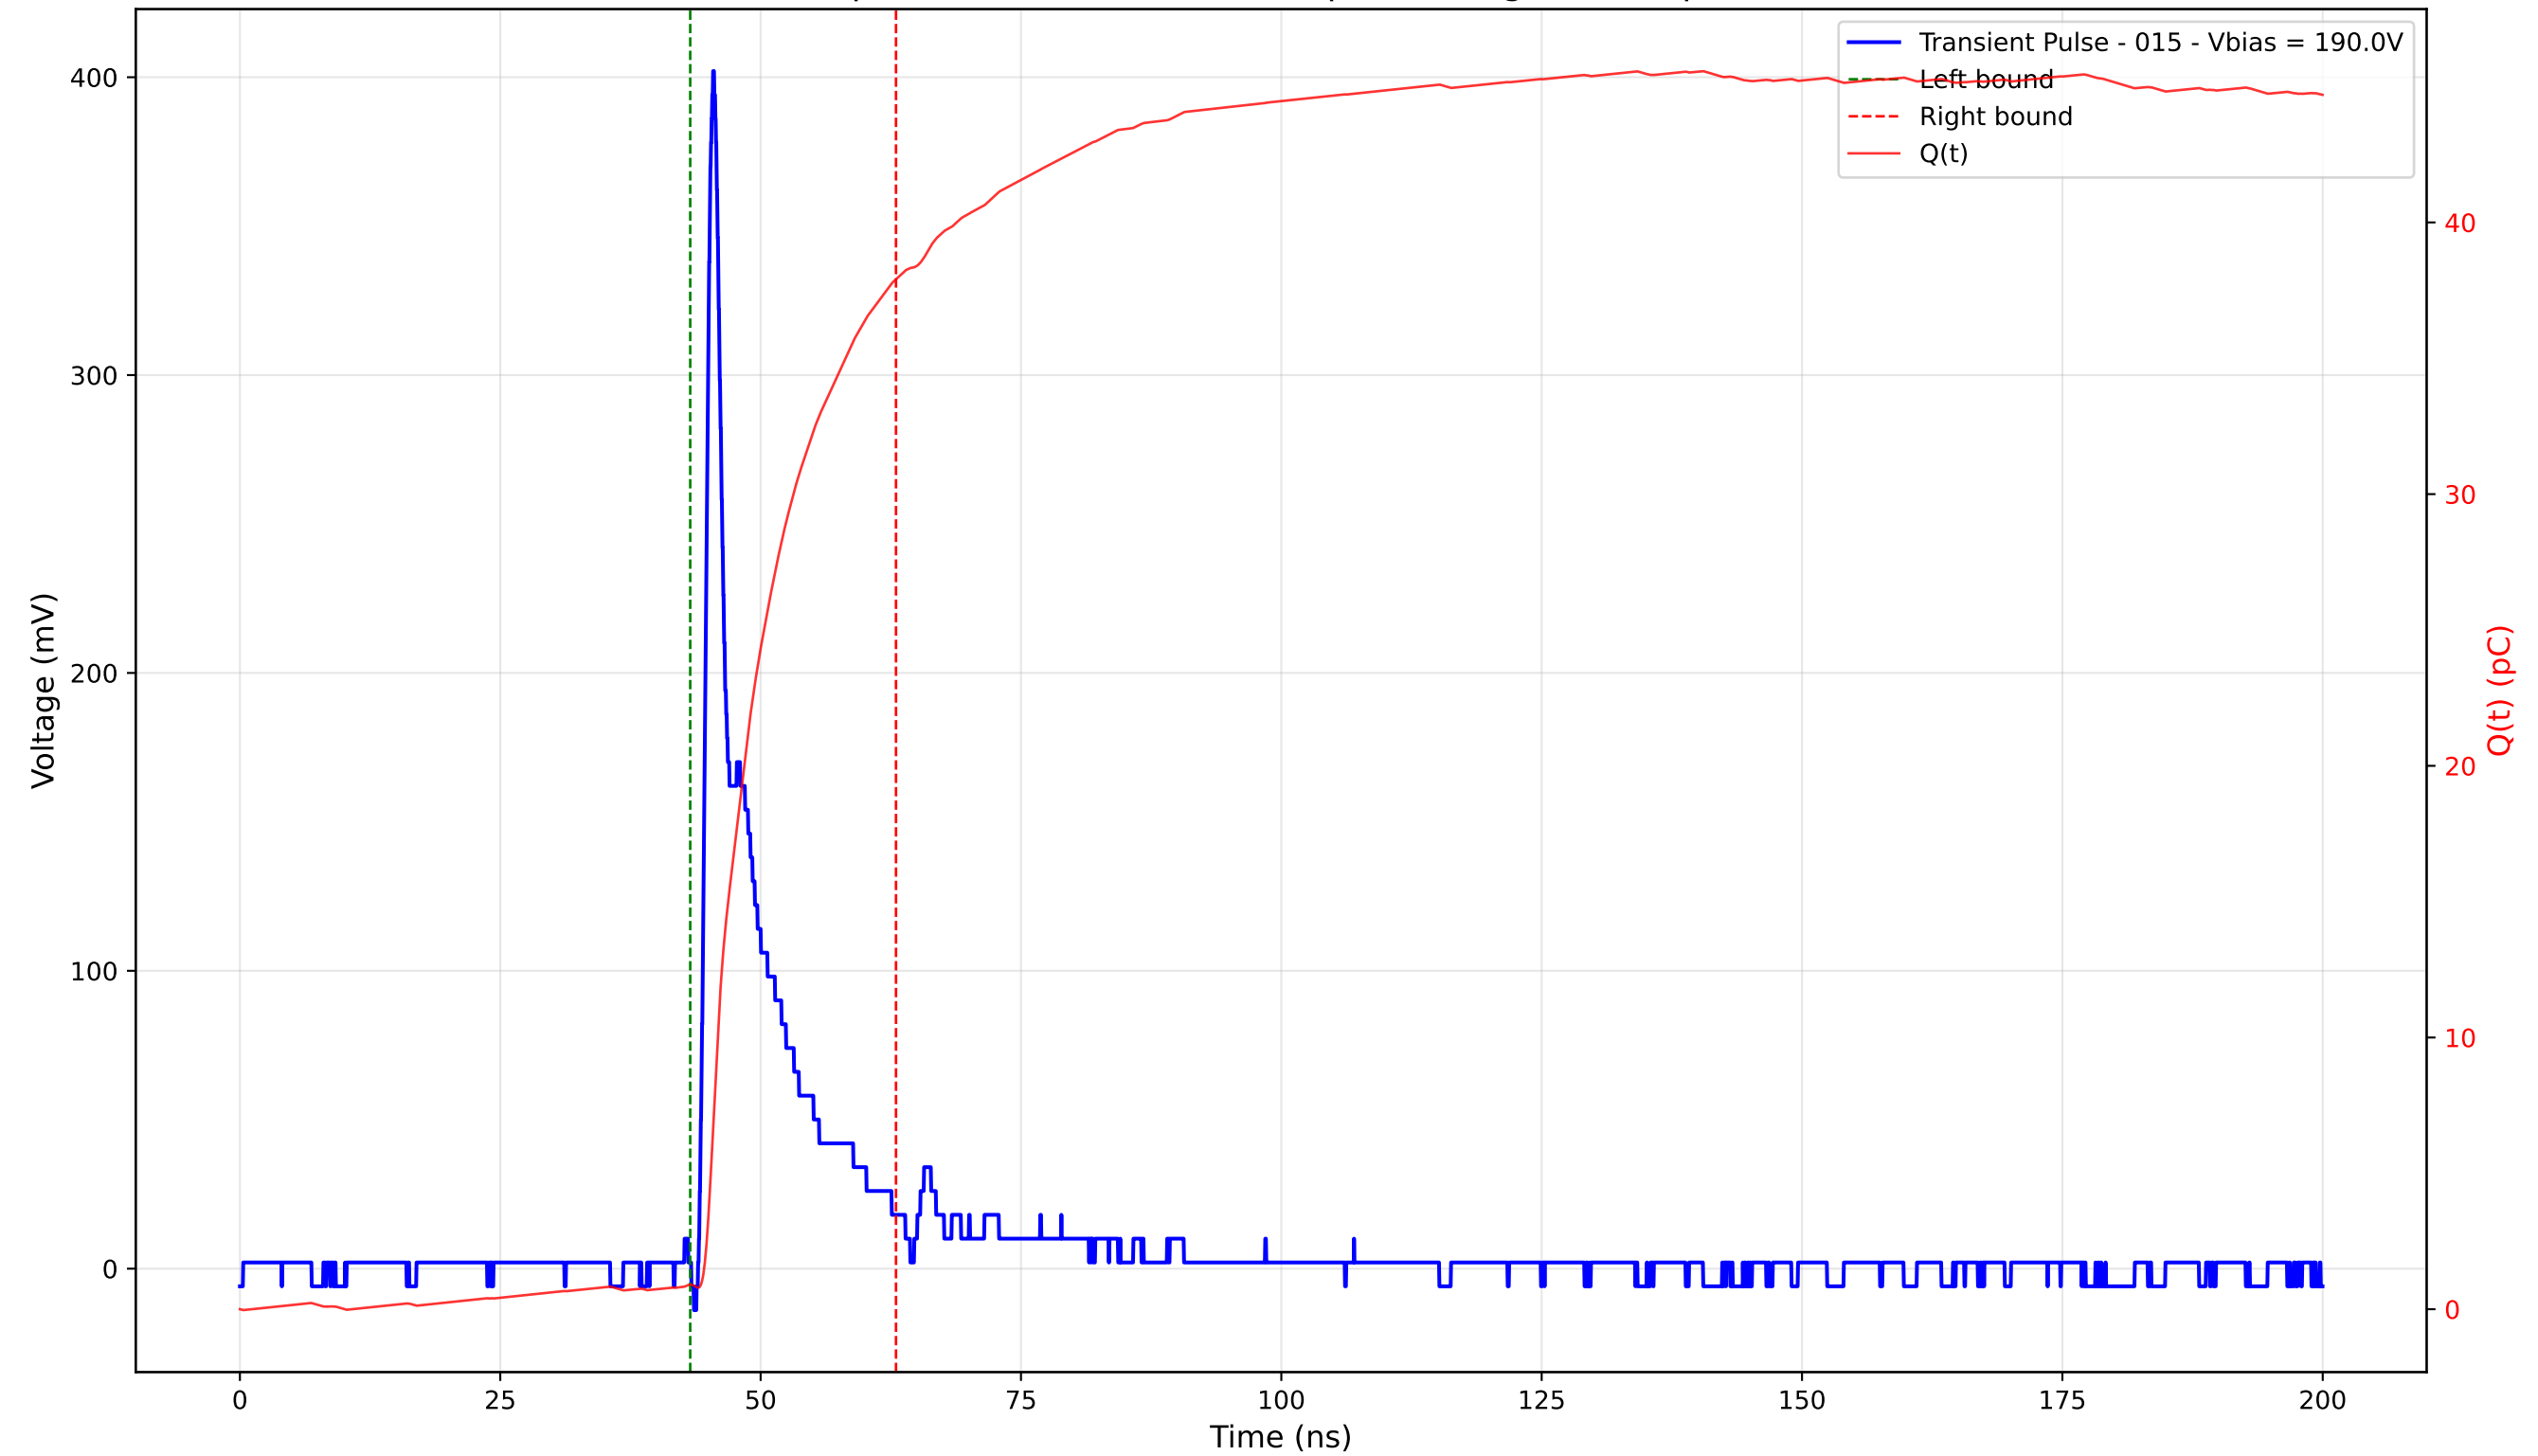


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 41.44 pC - Rise Time: 0.91 ns

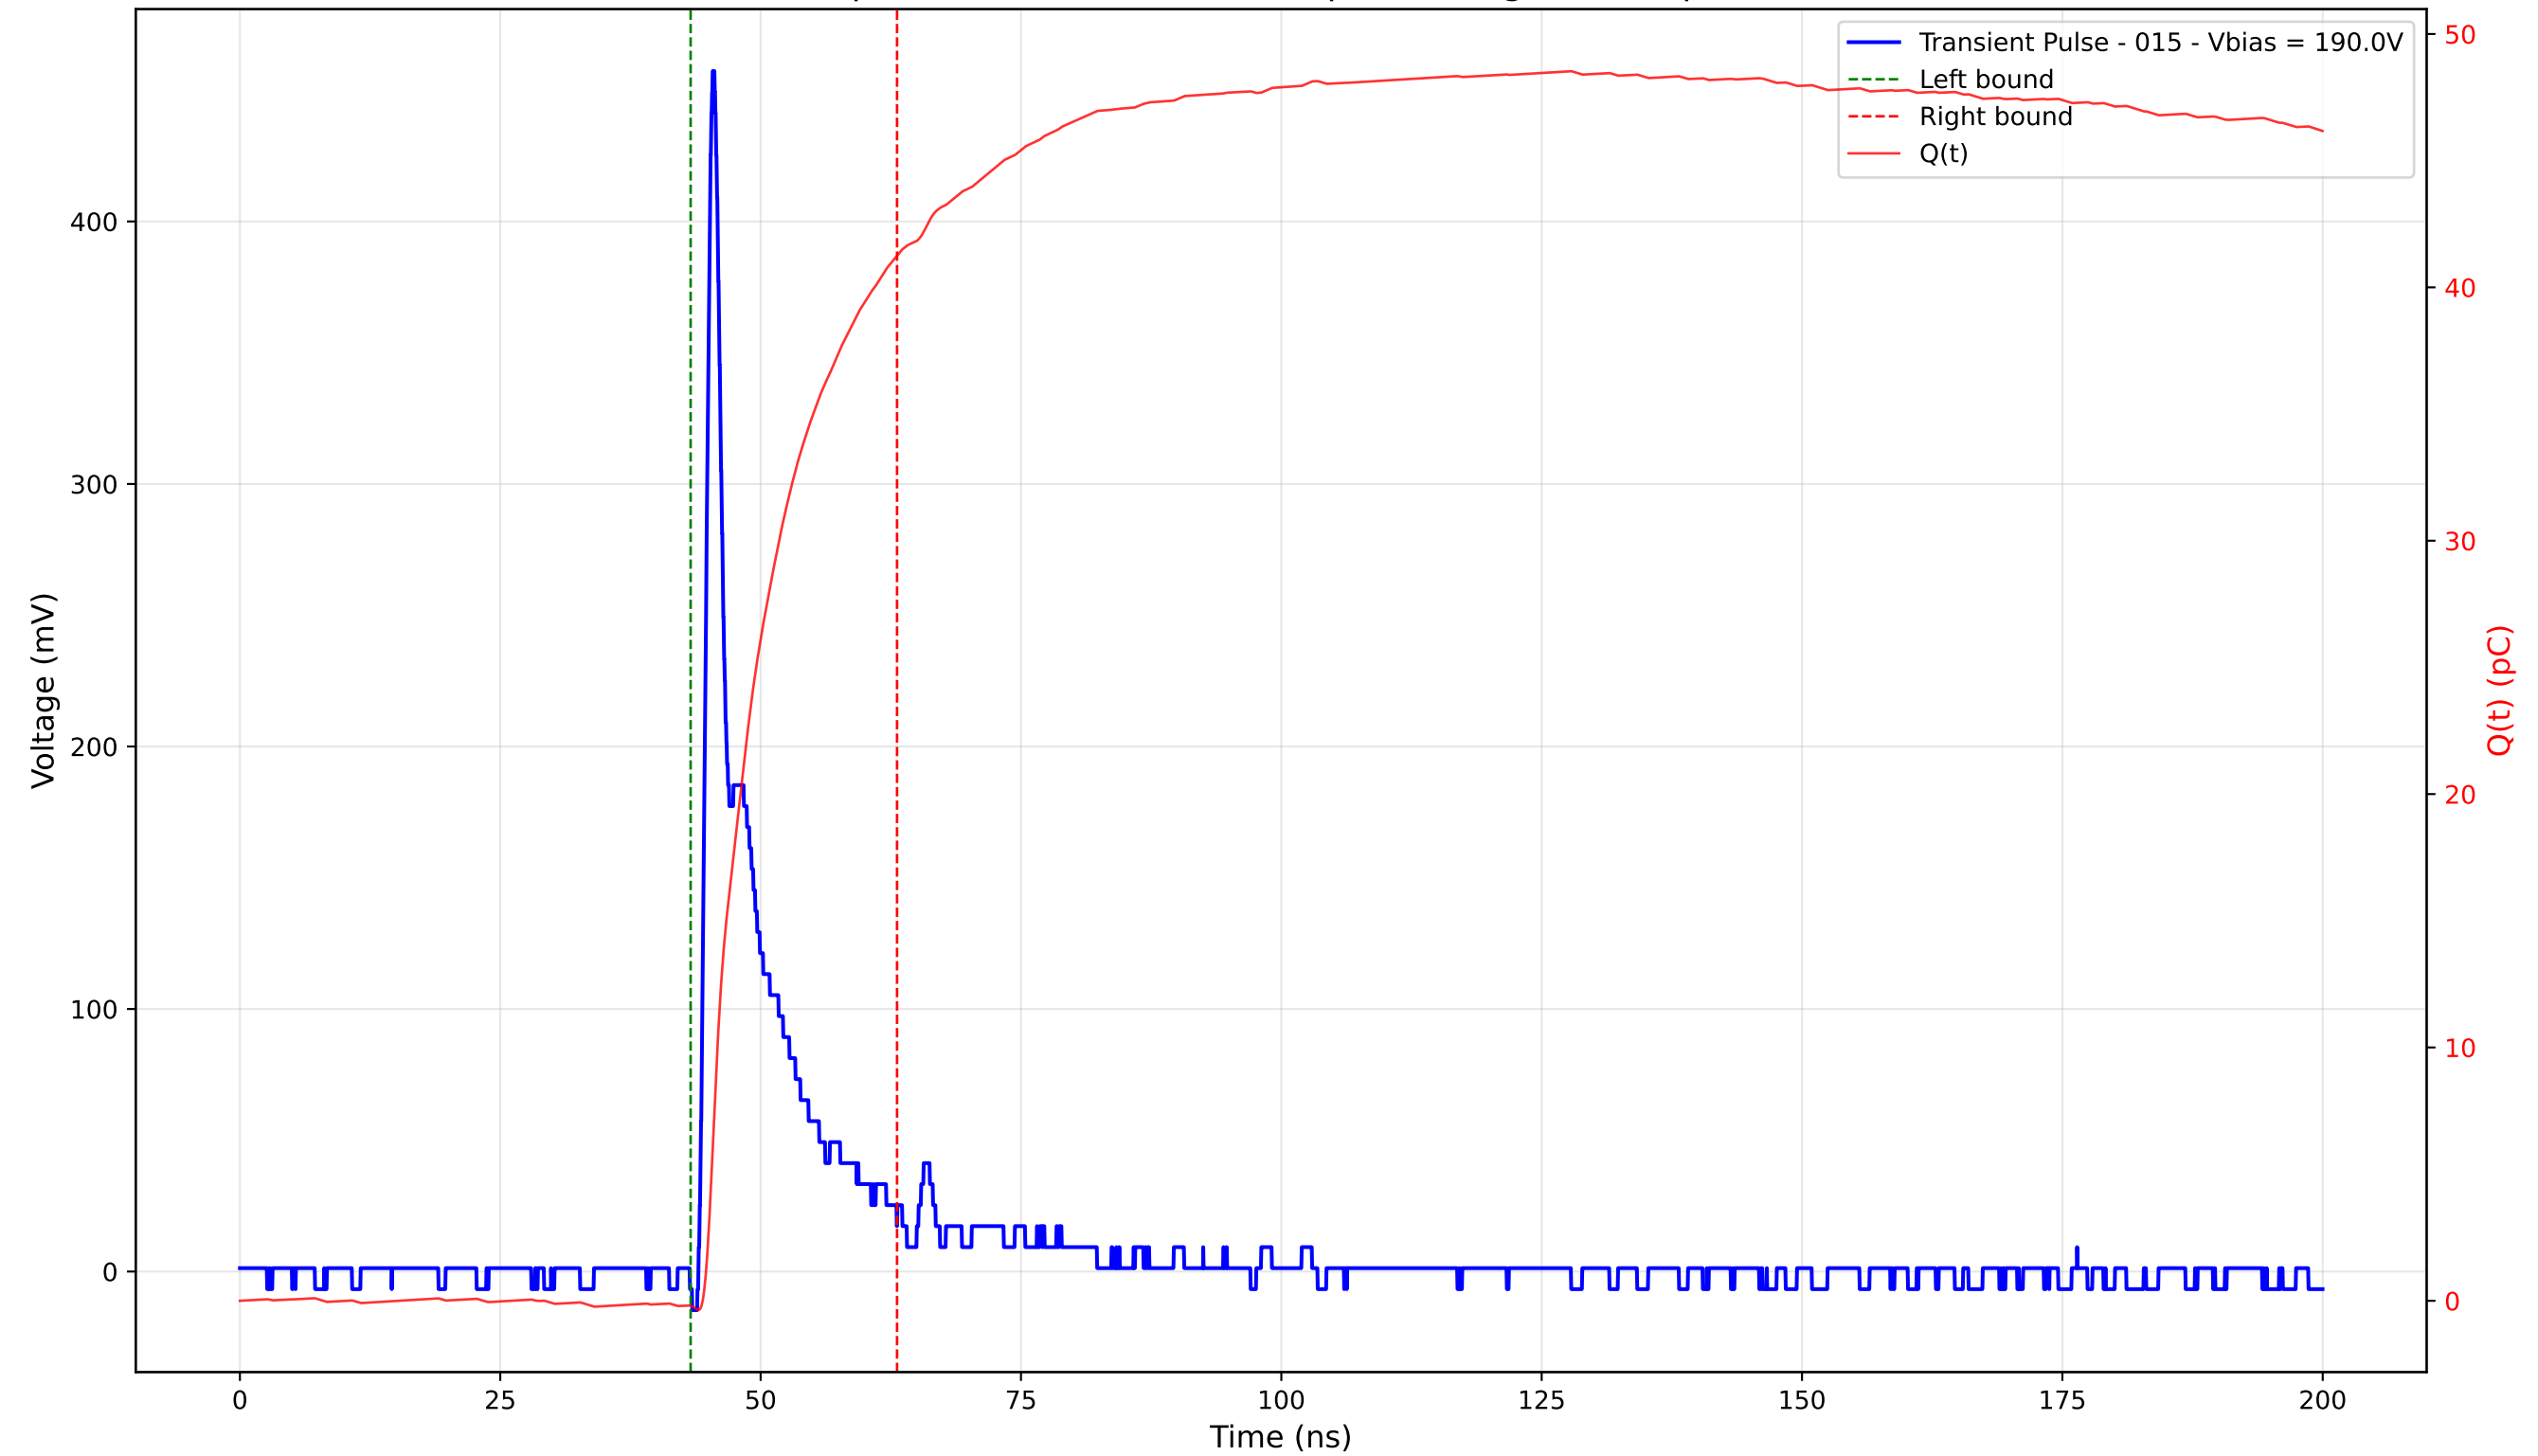


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 44.59 pC - Rise Time: 0.90 ns

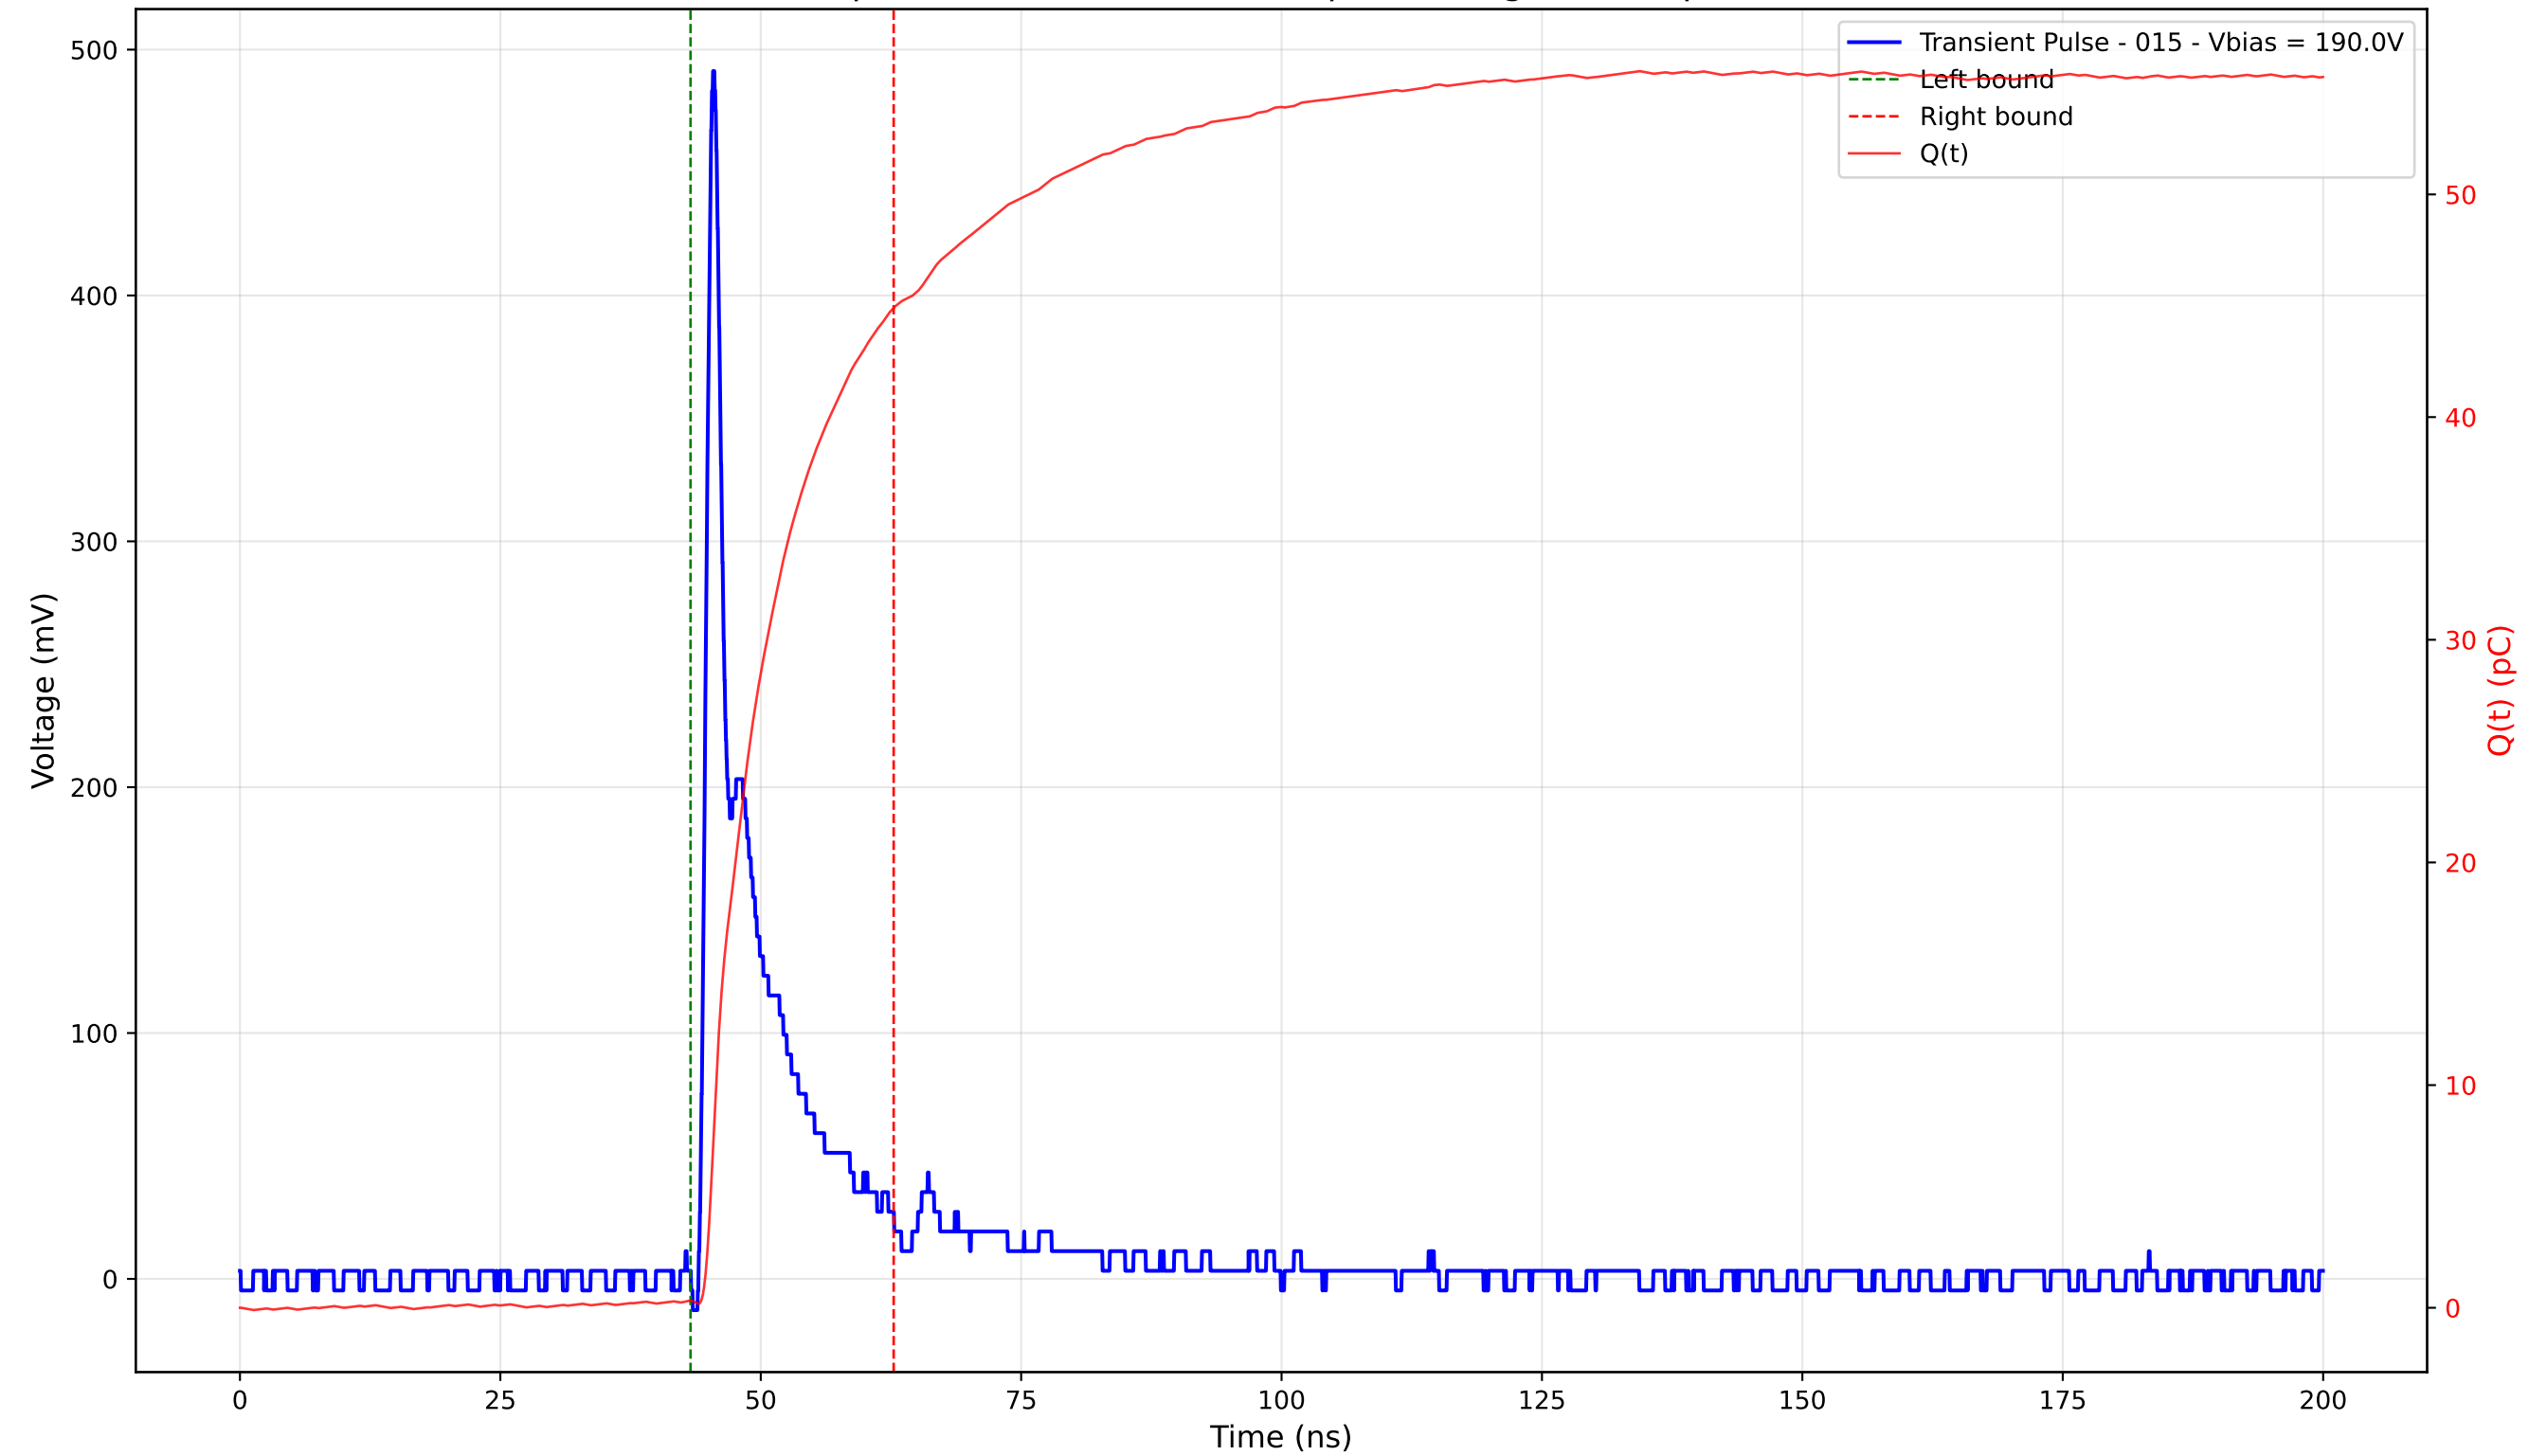


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 45.57 pC - Rise Time: 0.91 ns

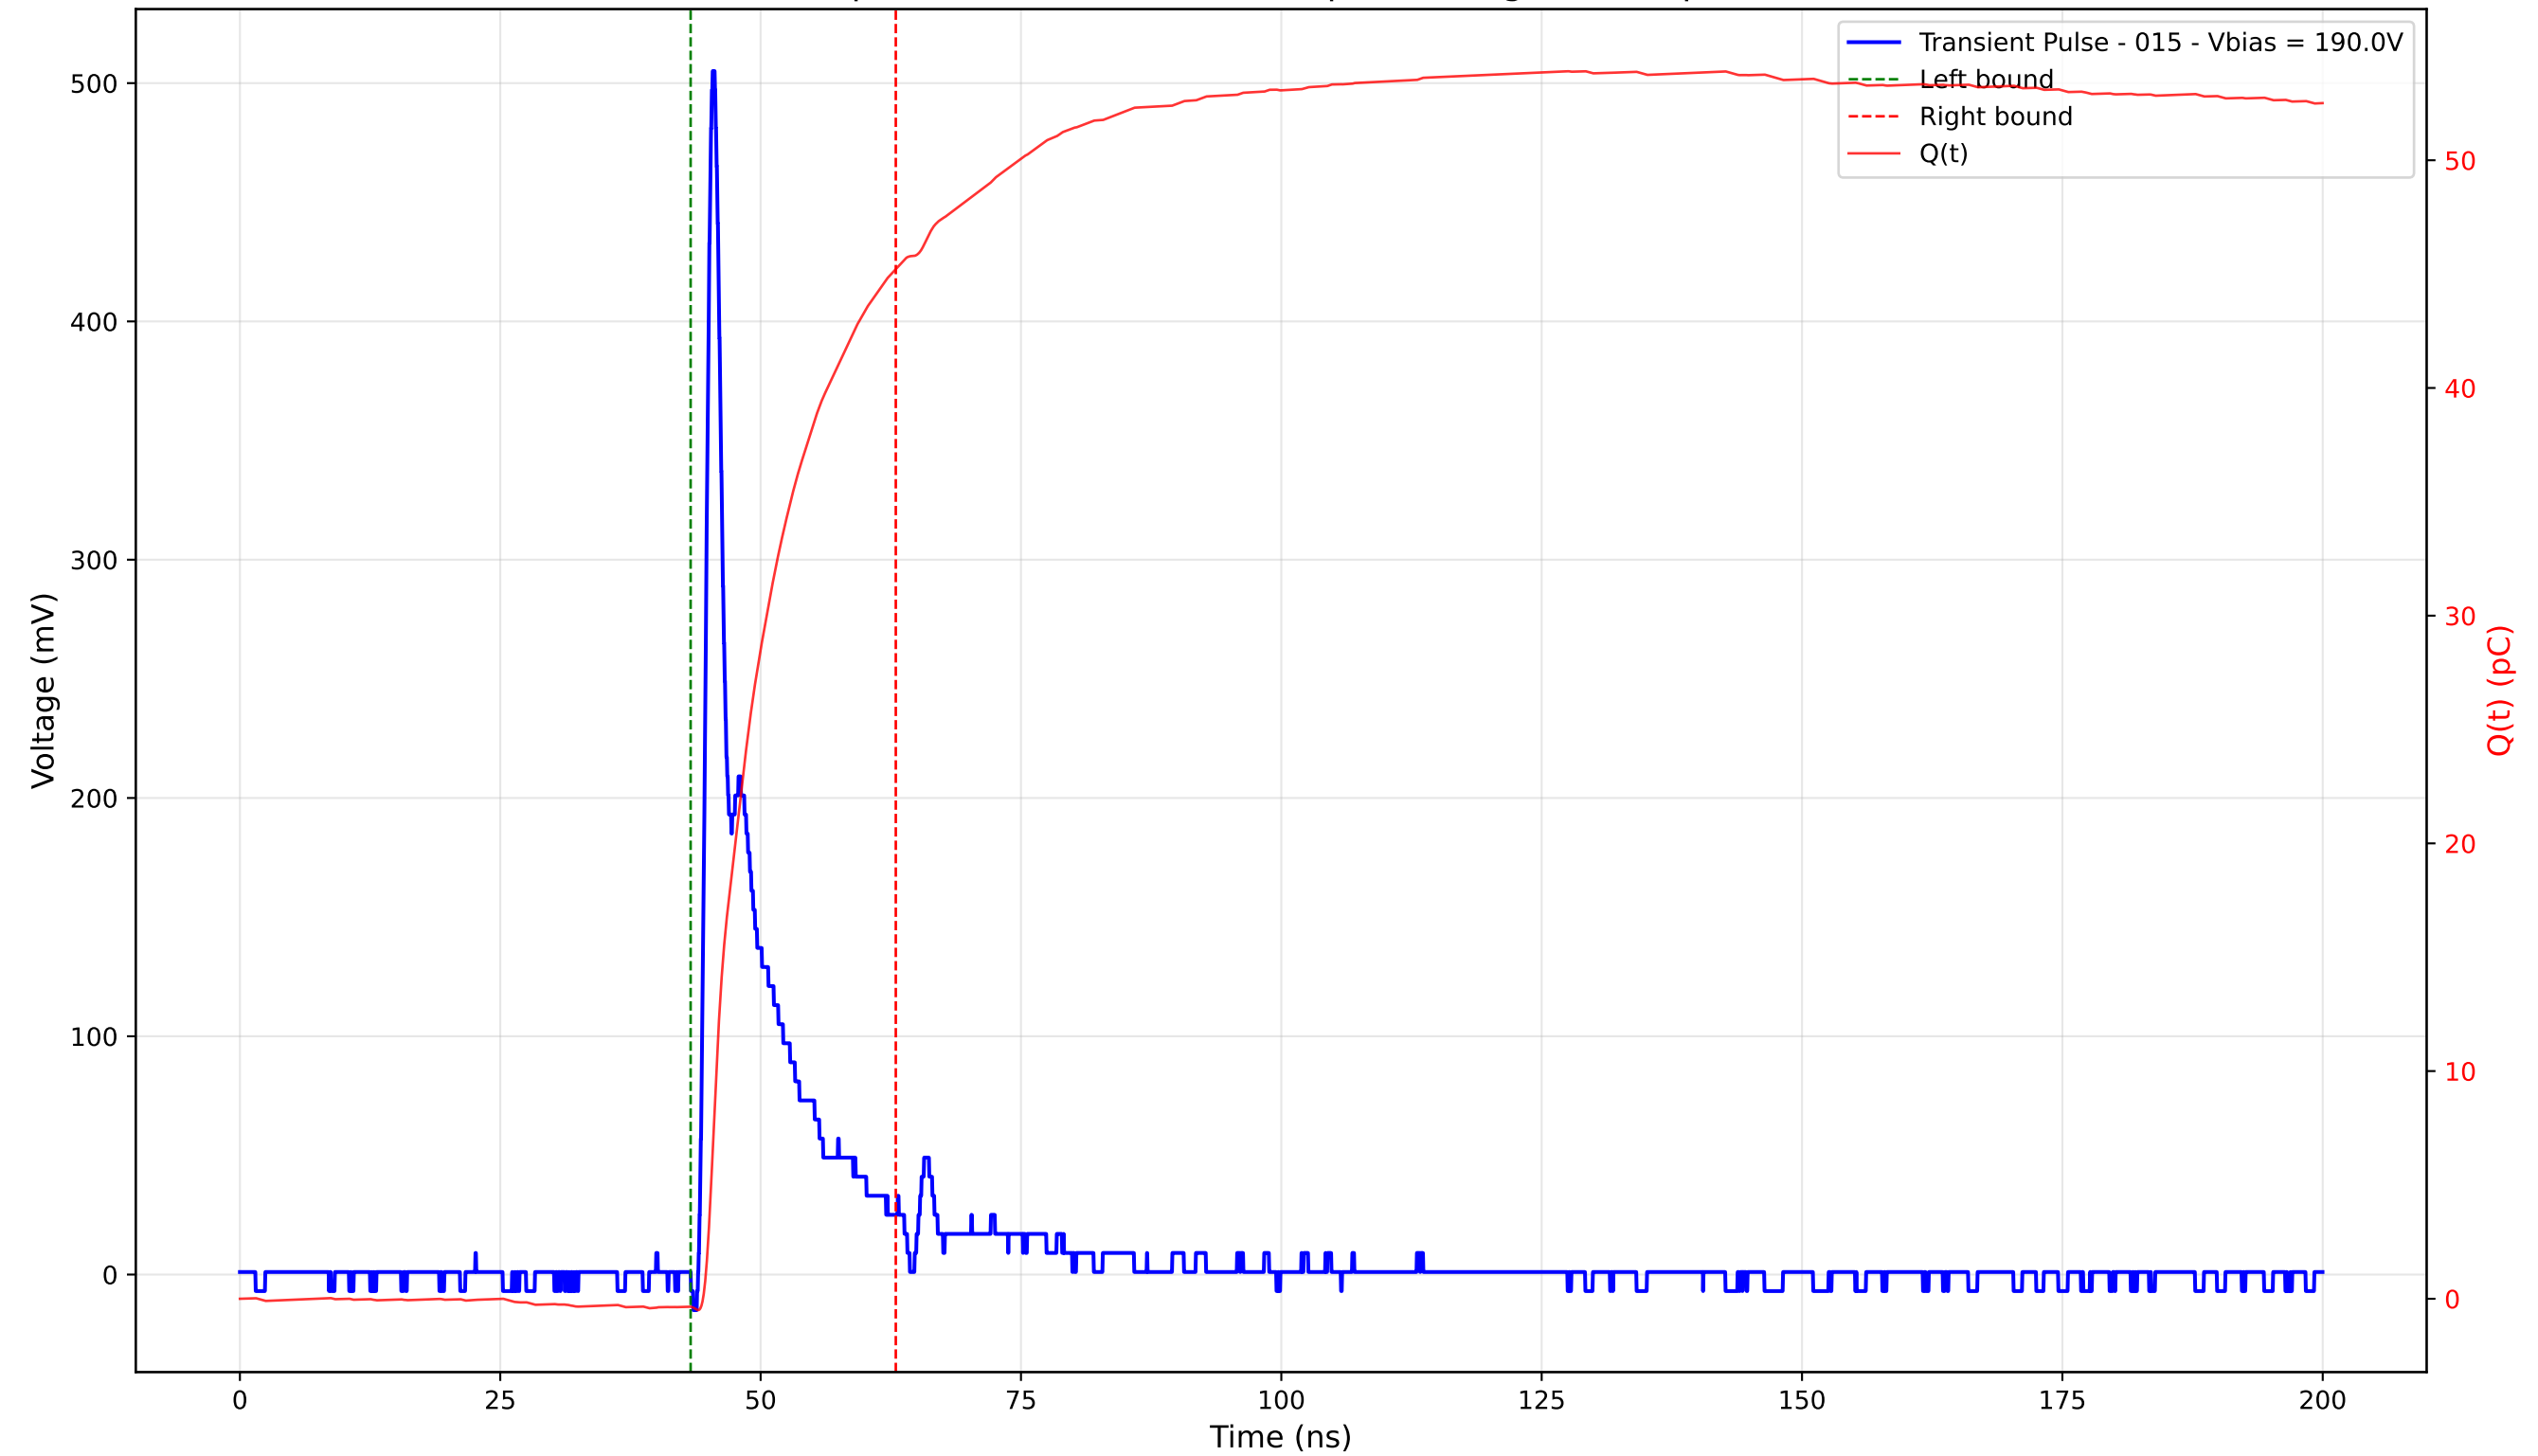


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 47.08 pC - Rise Time: 0.91 ns

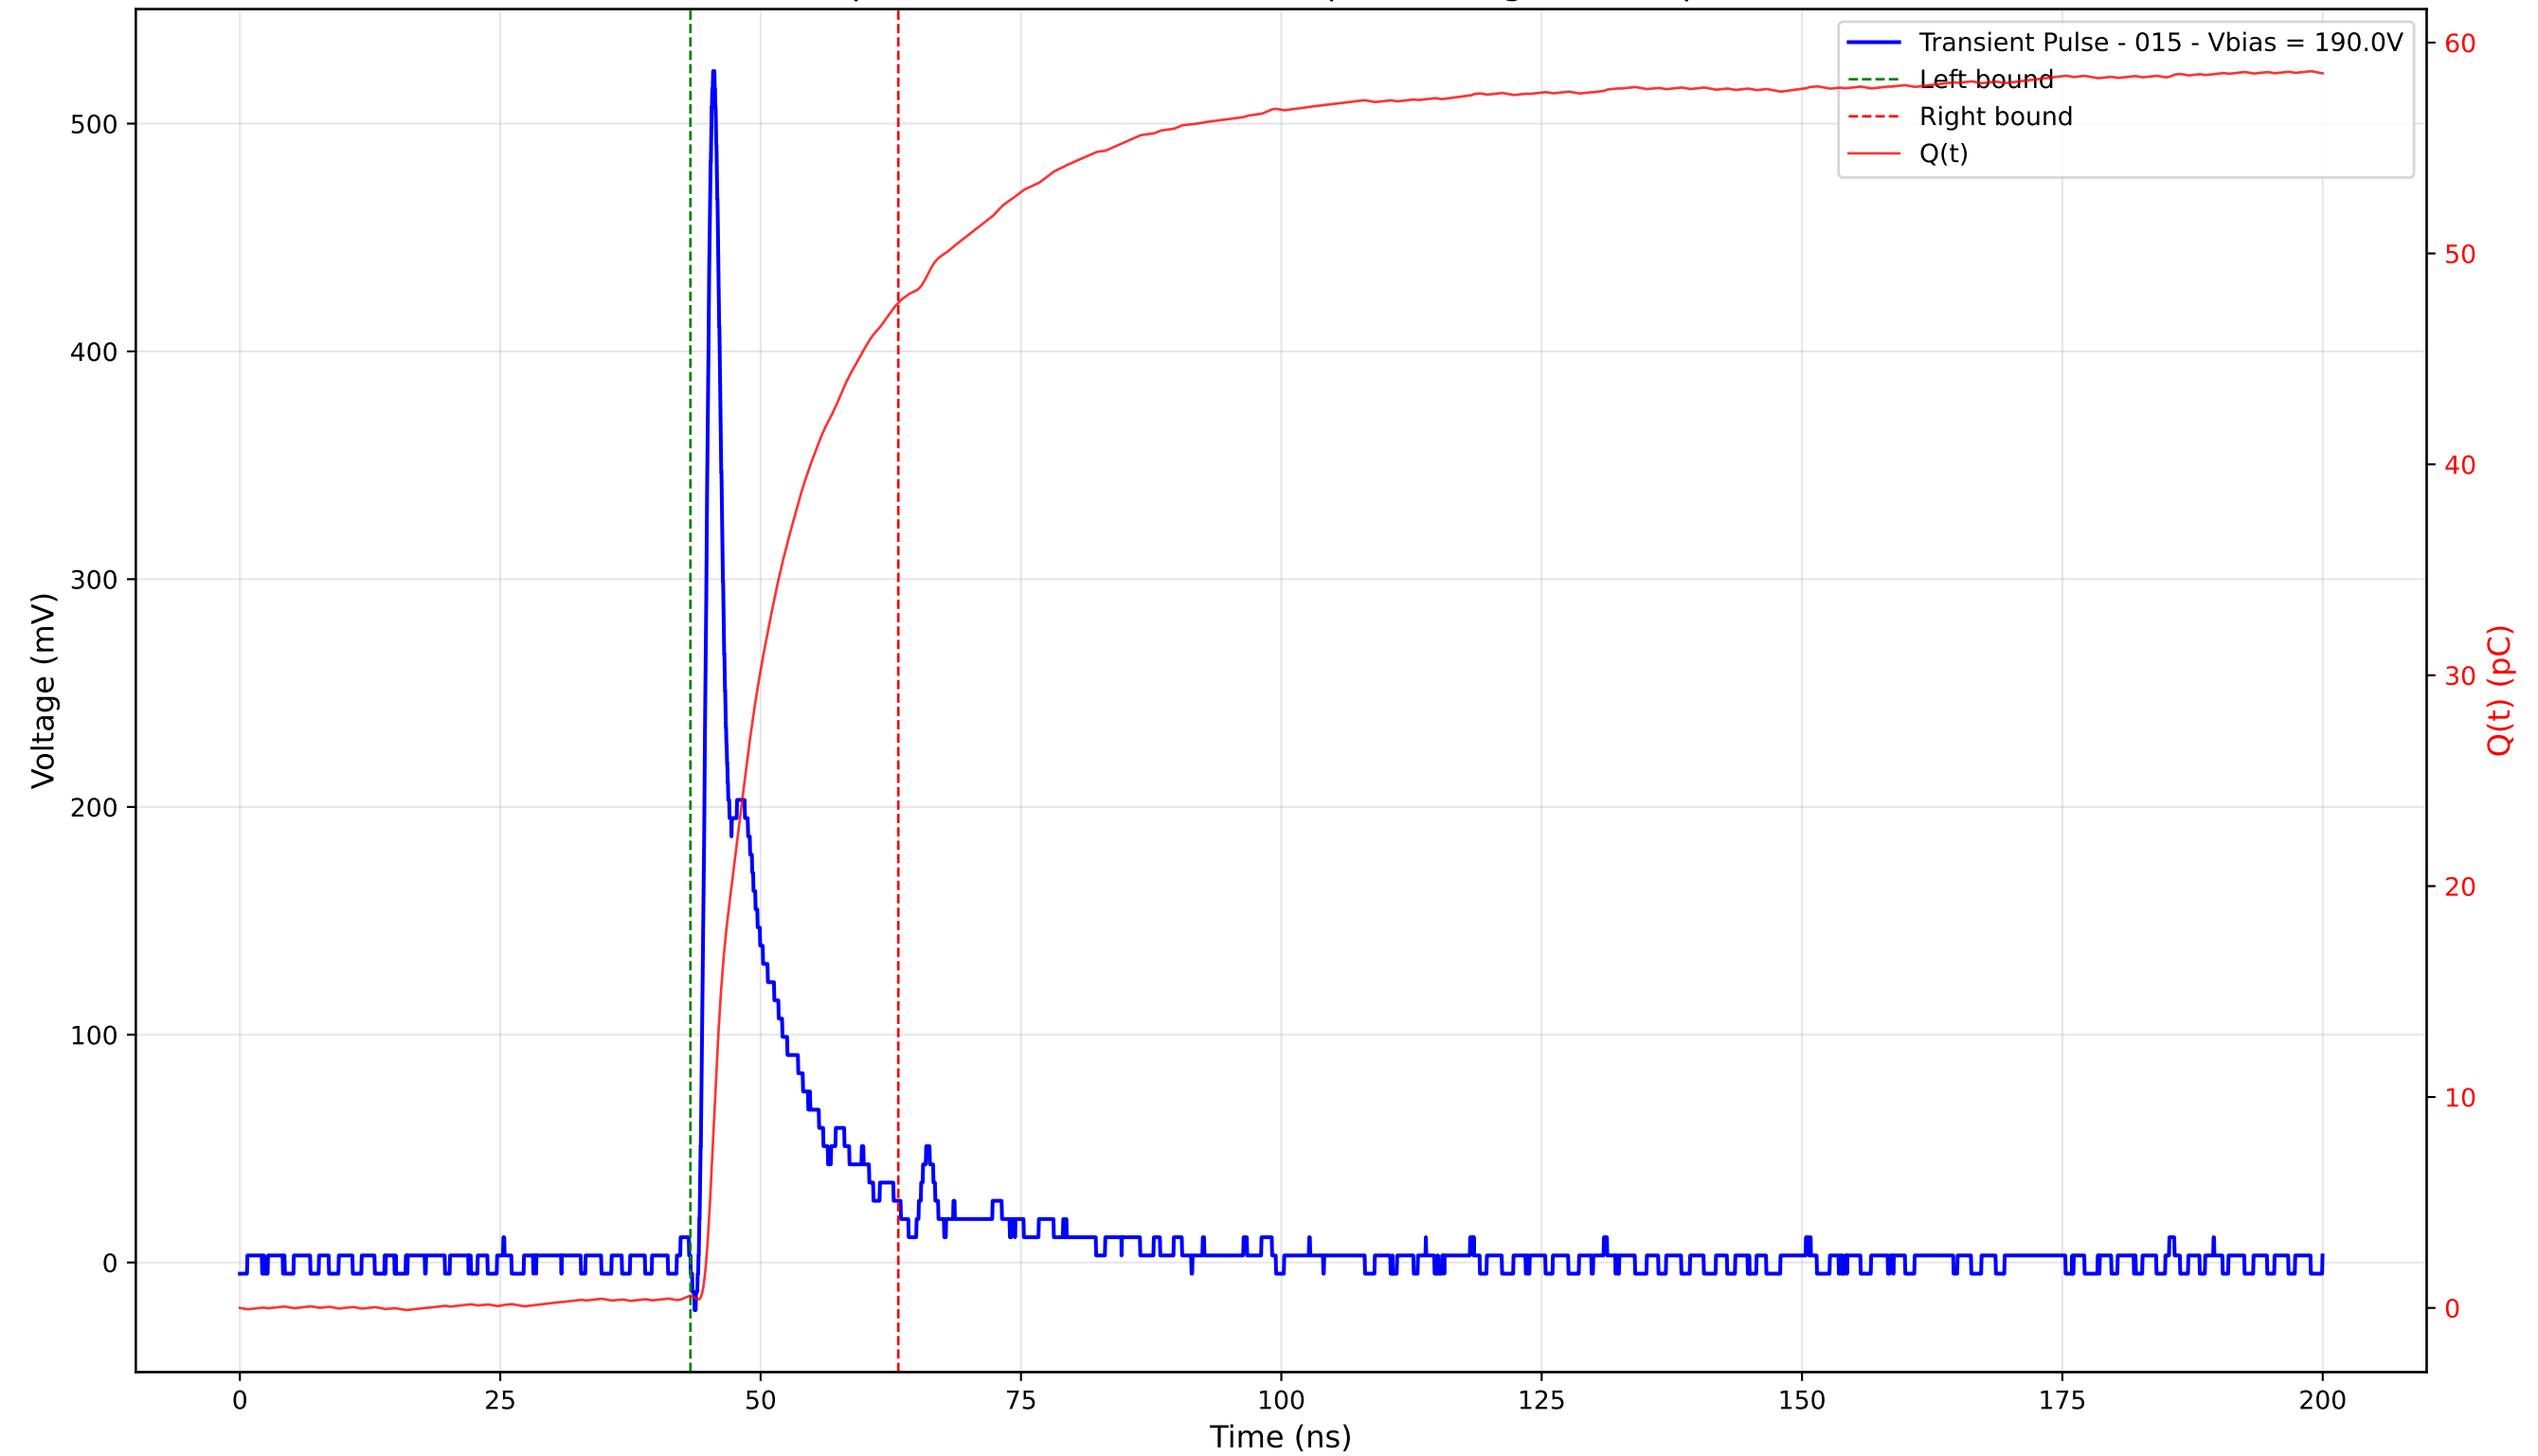


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 46.58 pC - Rise Time: 0.91 ns

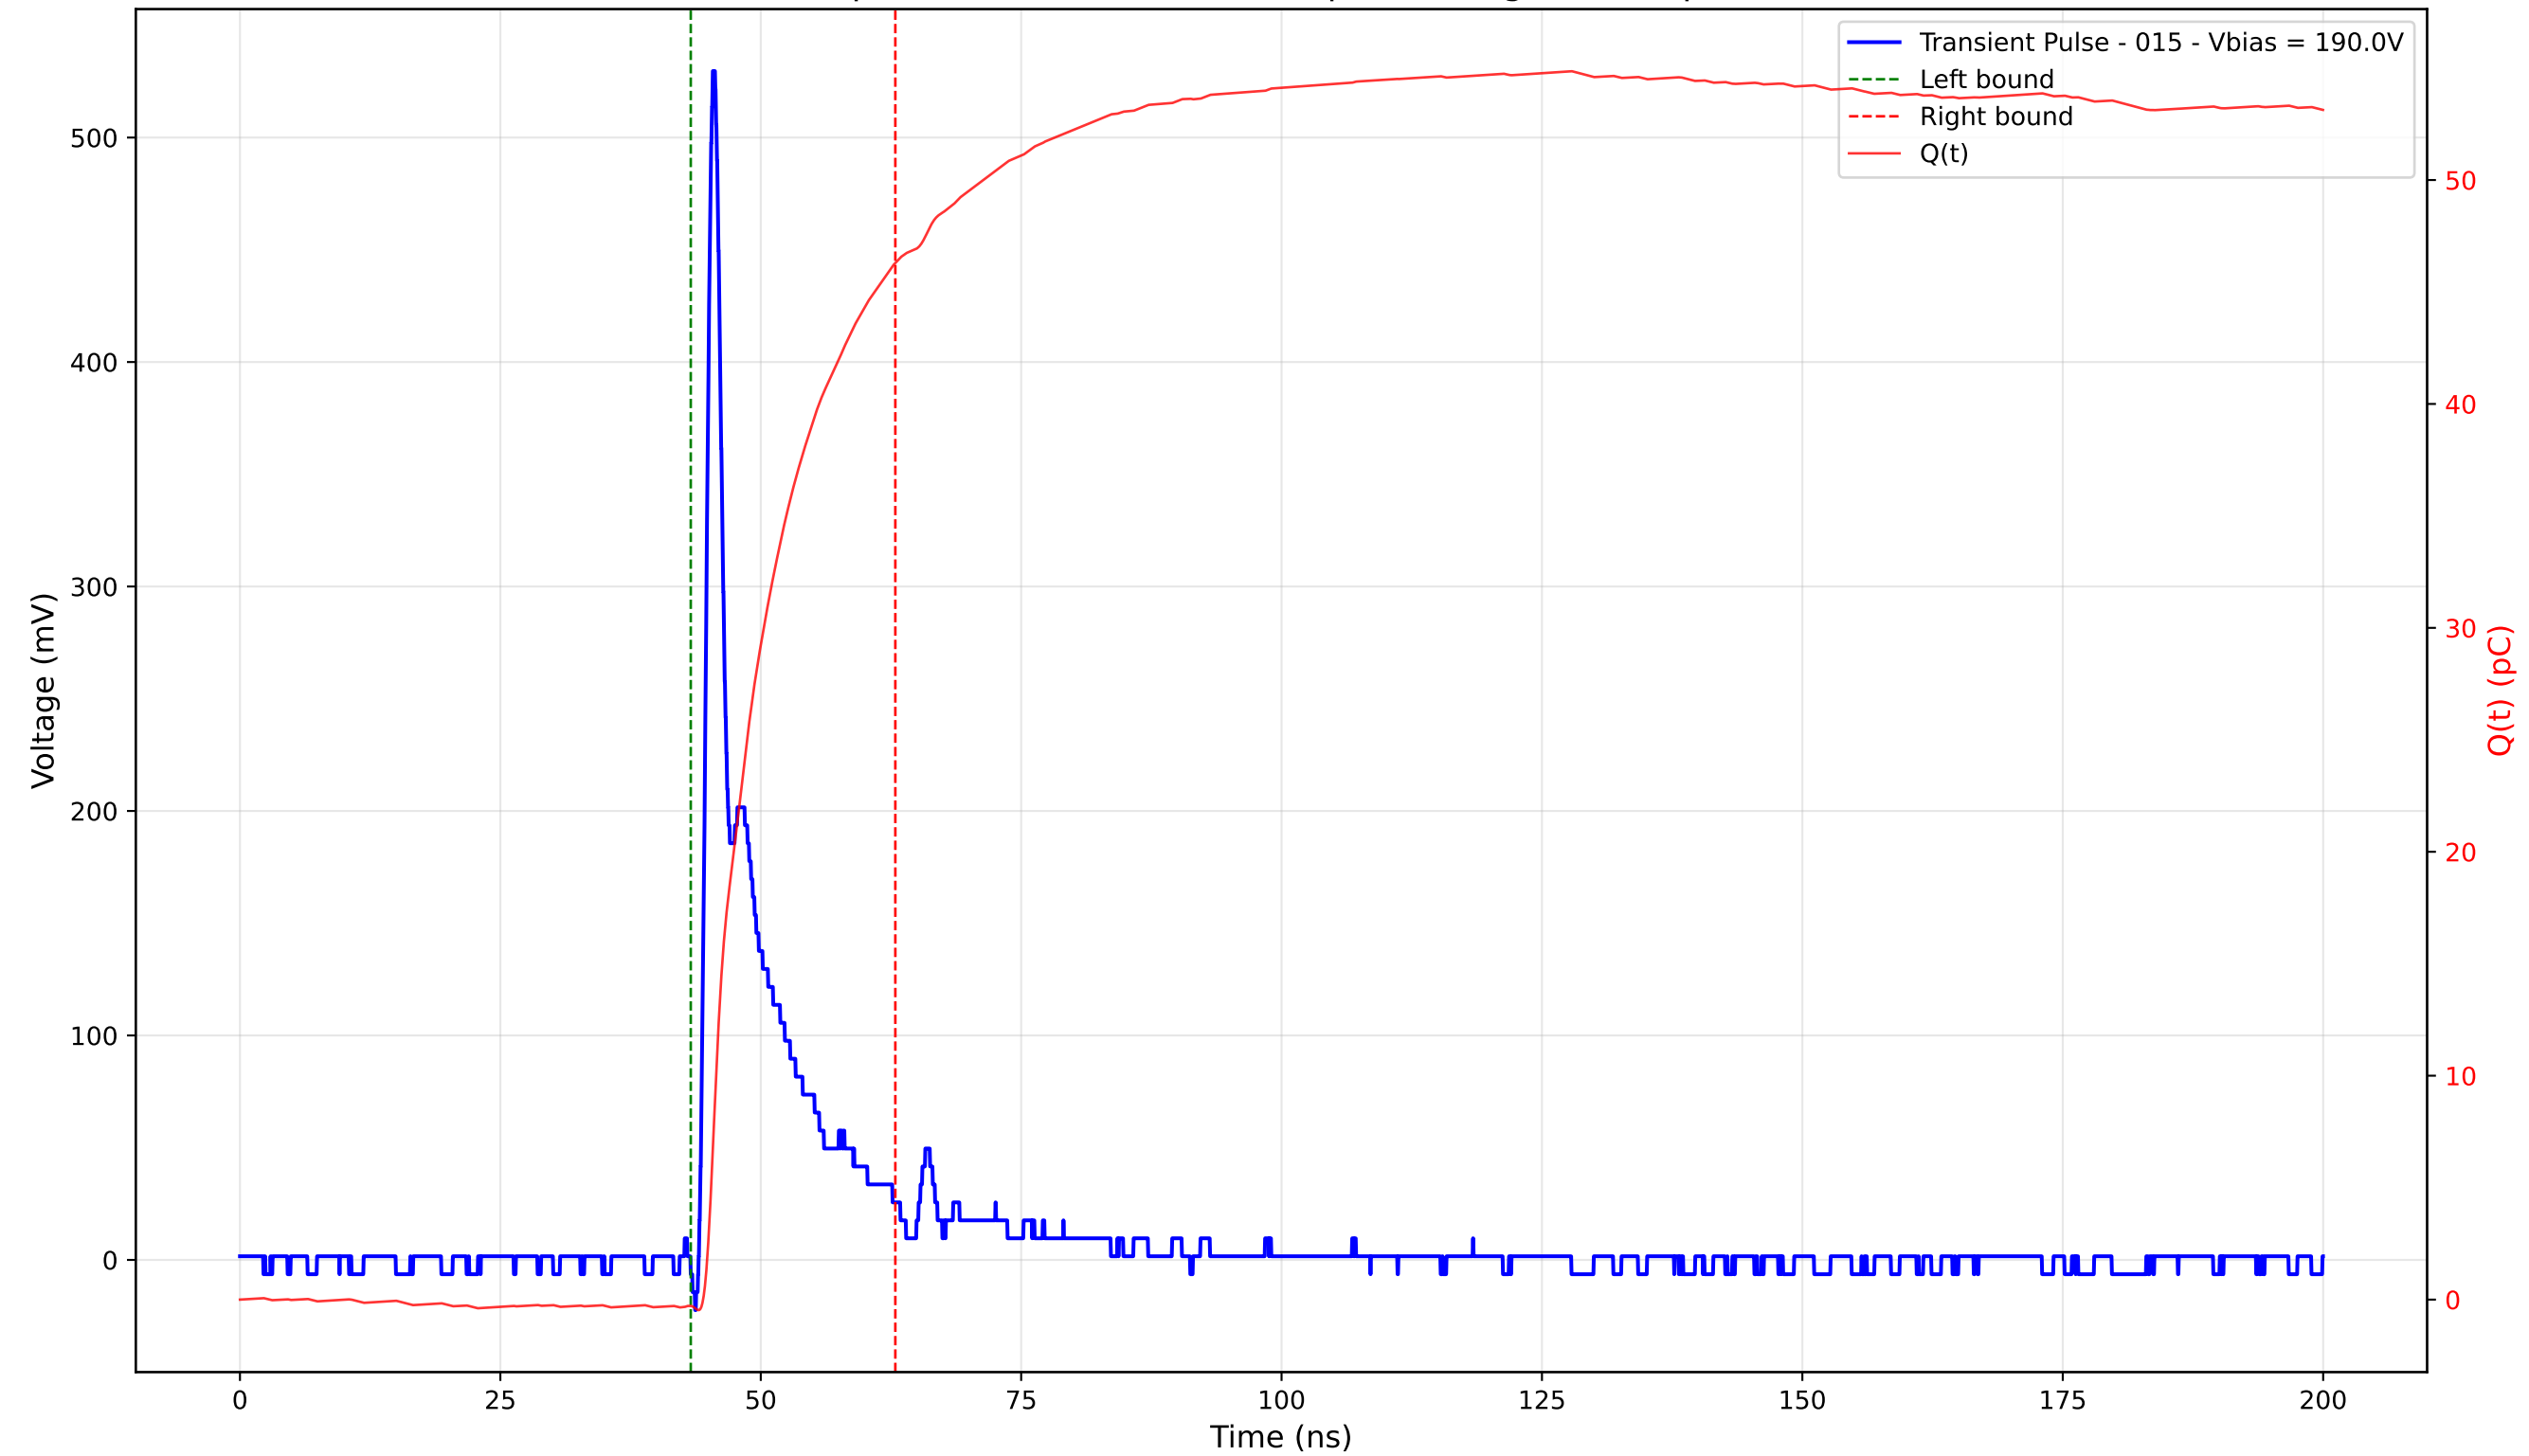


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 46.47 pC - Rise Time: 0.92 ns

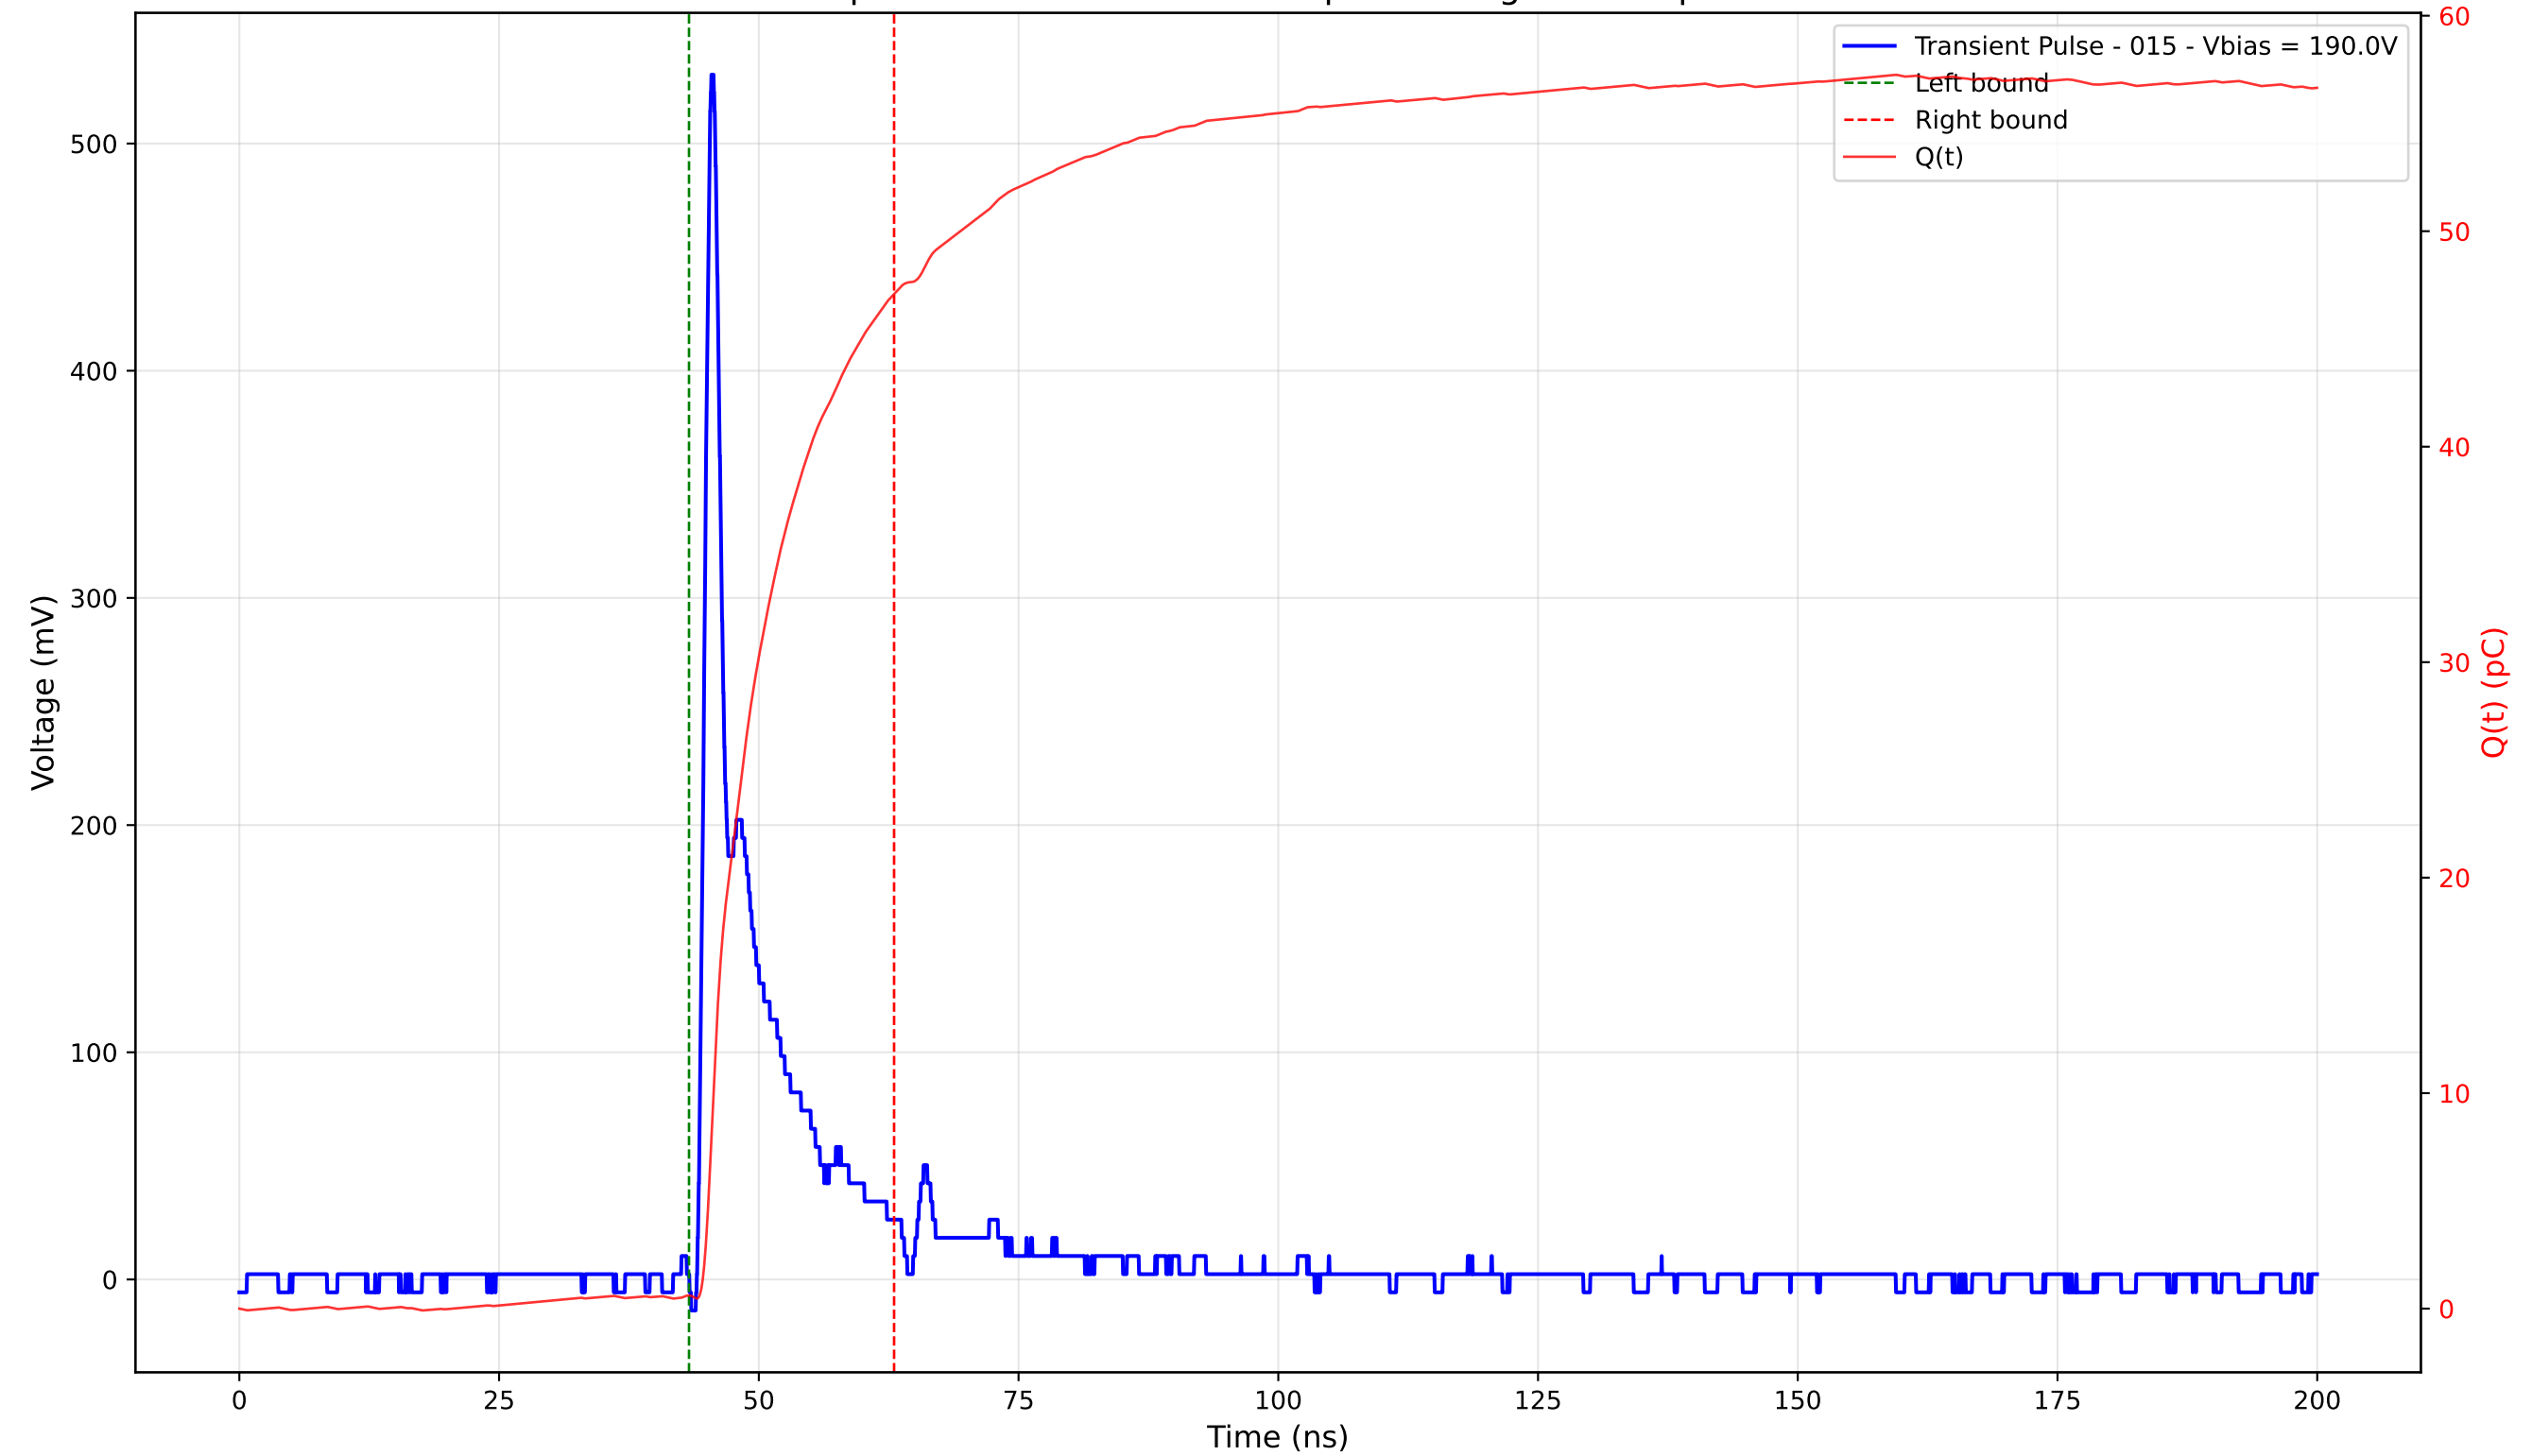


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 46.19 pC - Rise Time: 0.95 ns

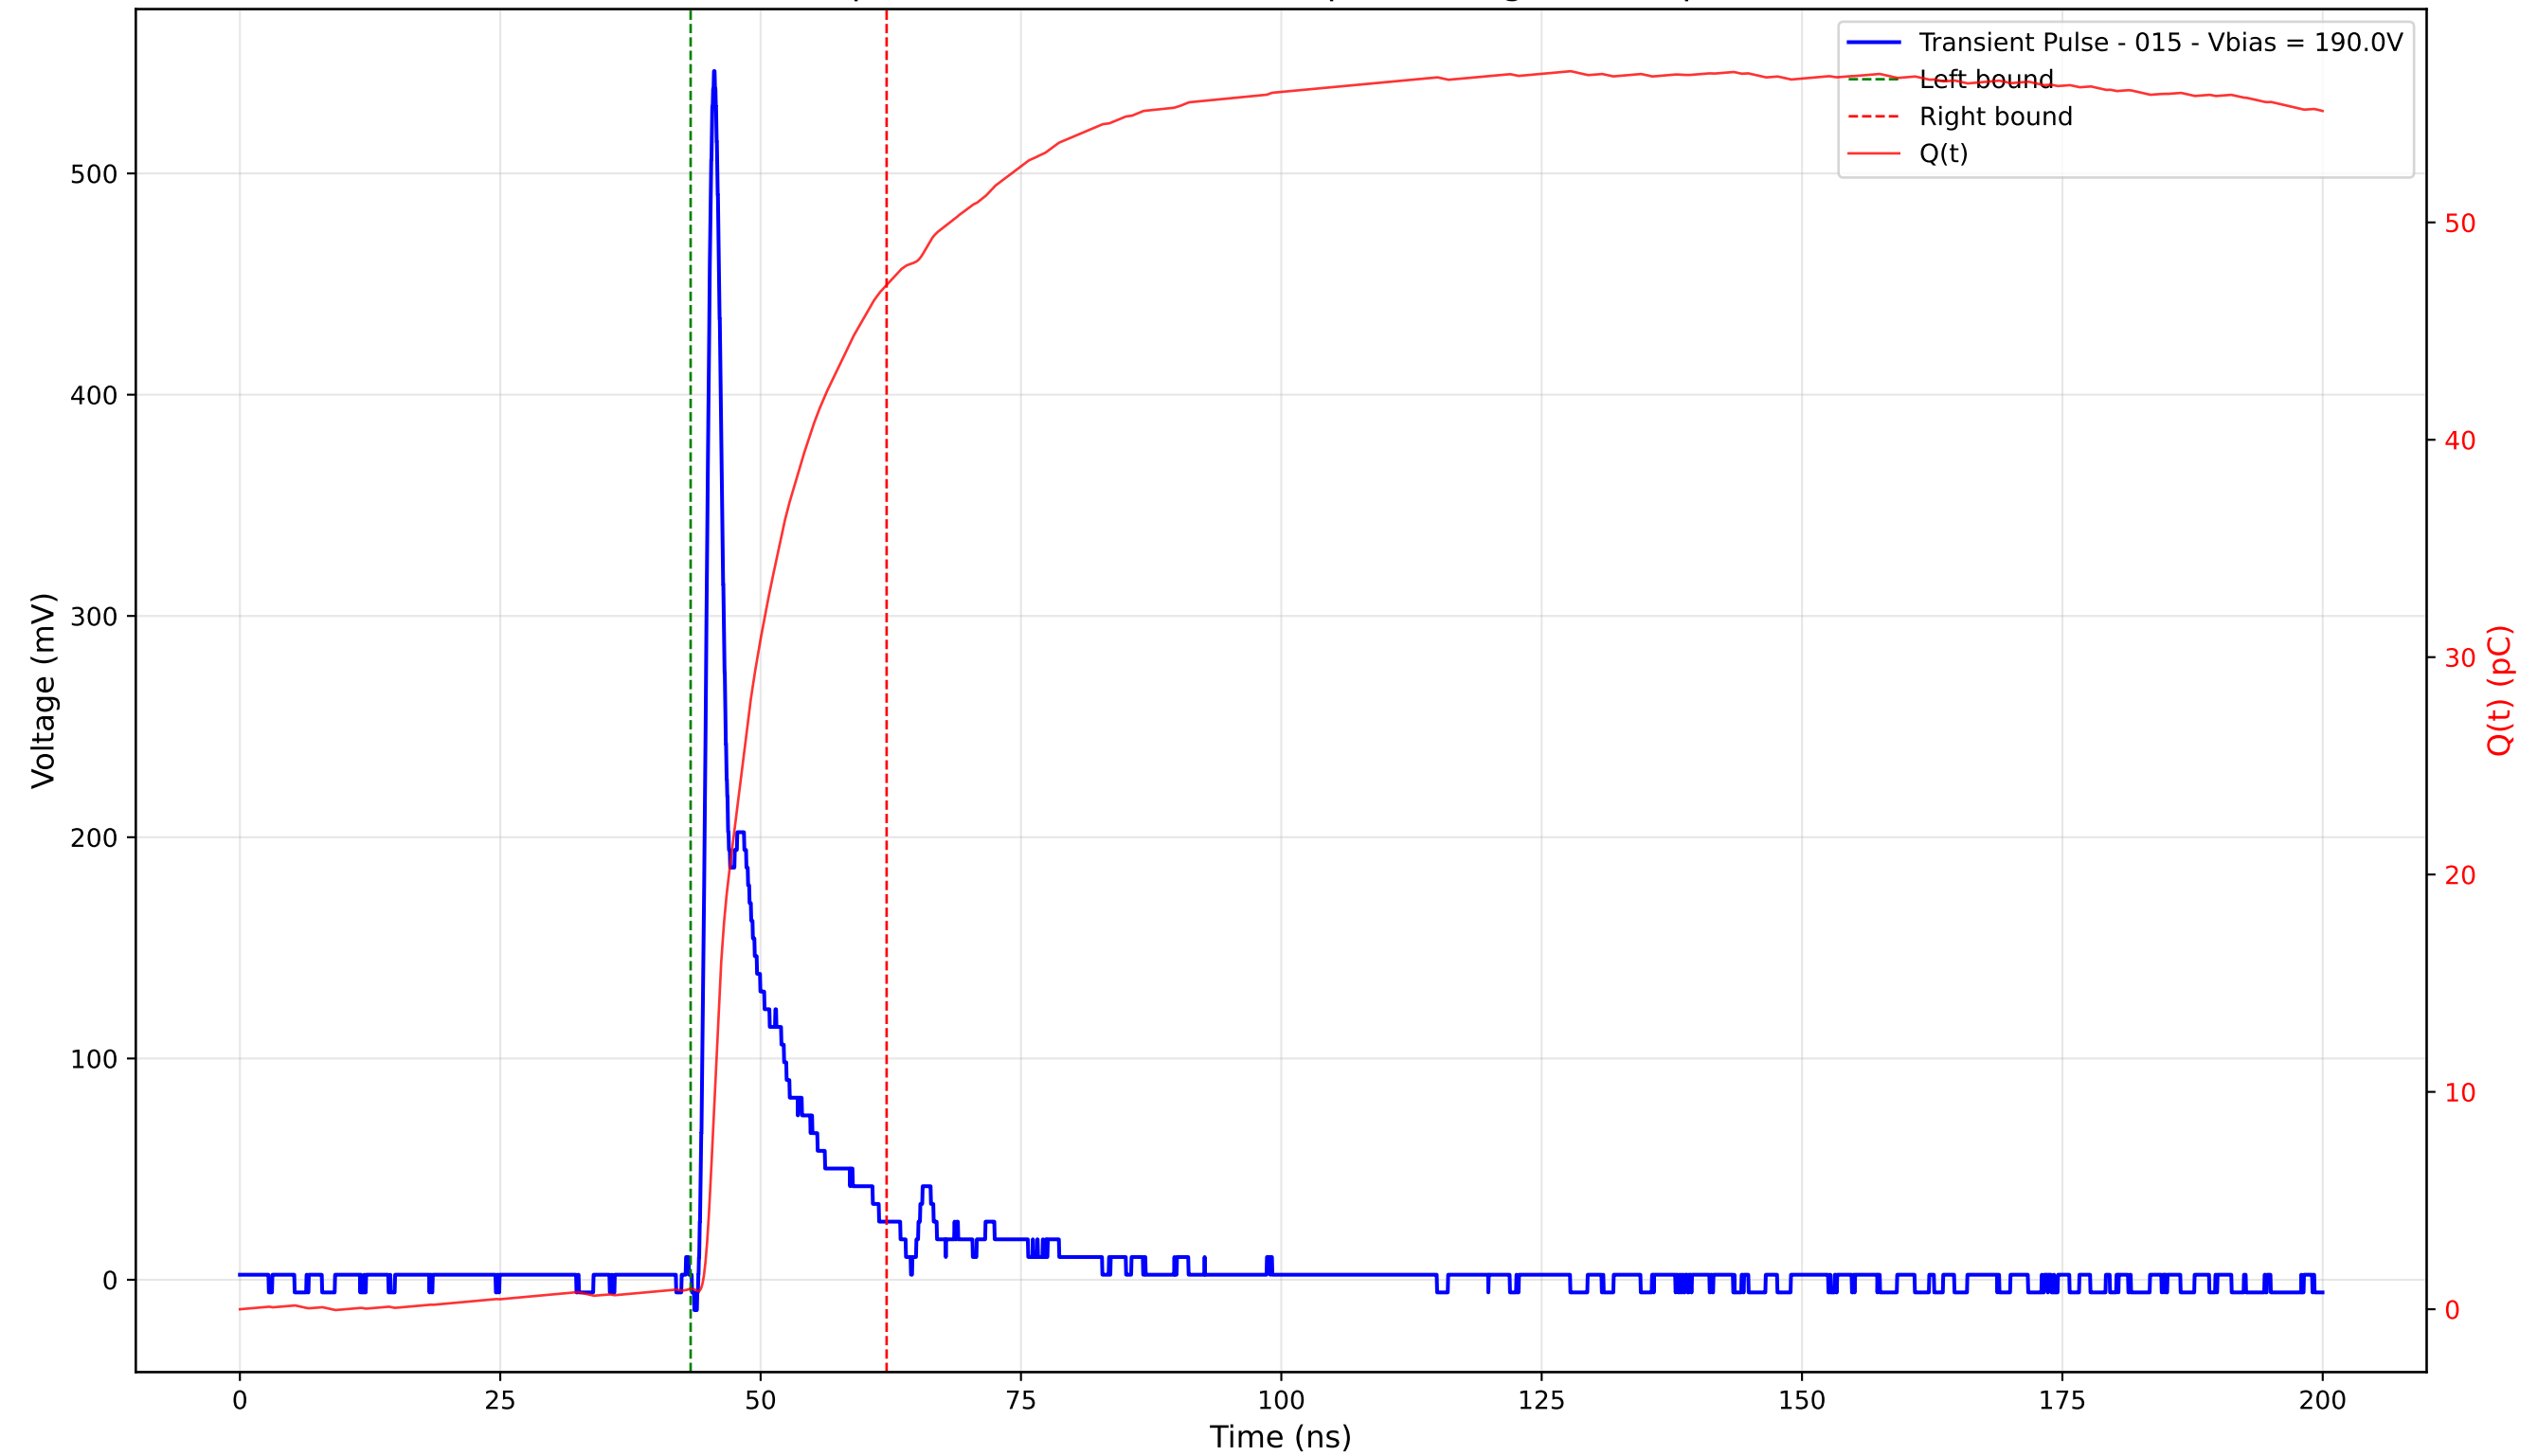


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 46.19 pC - Rise Time: 0.97 ns

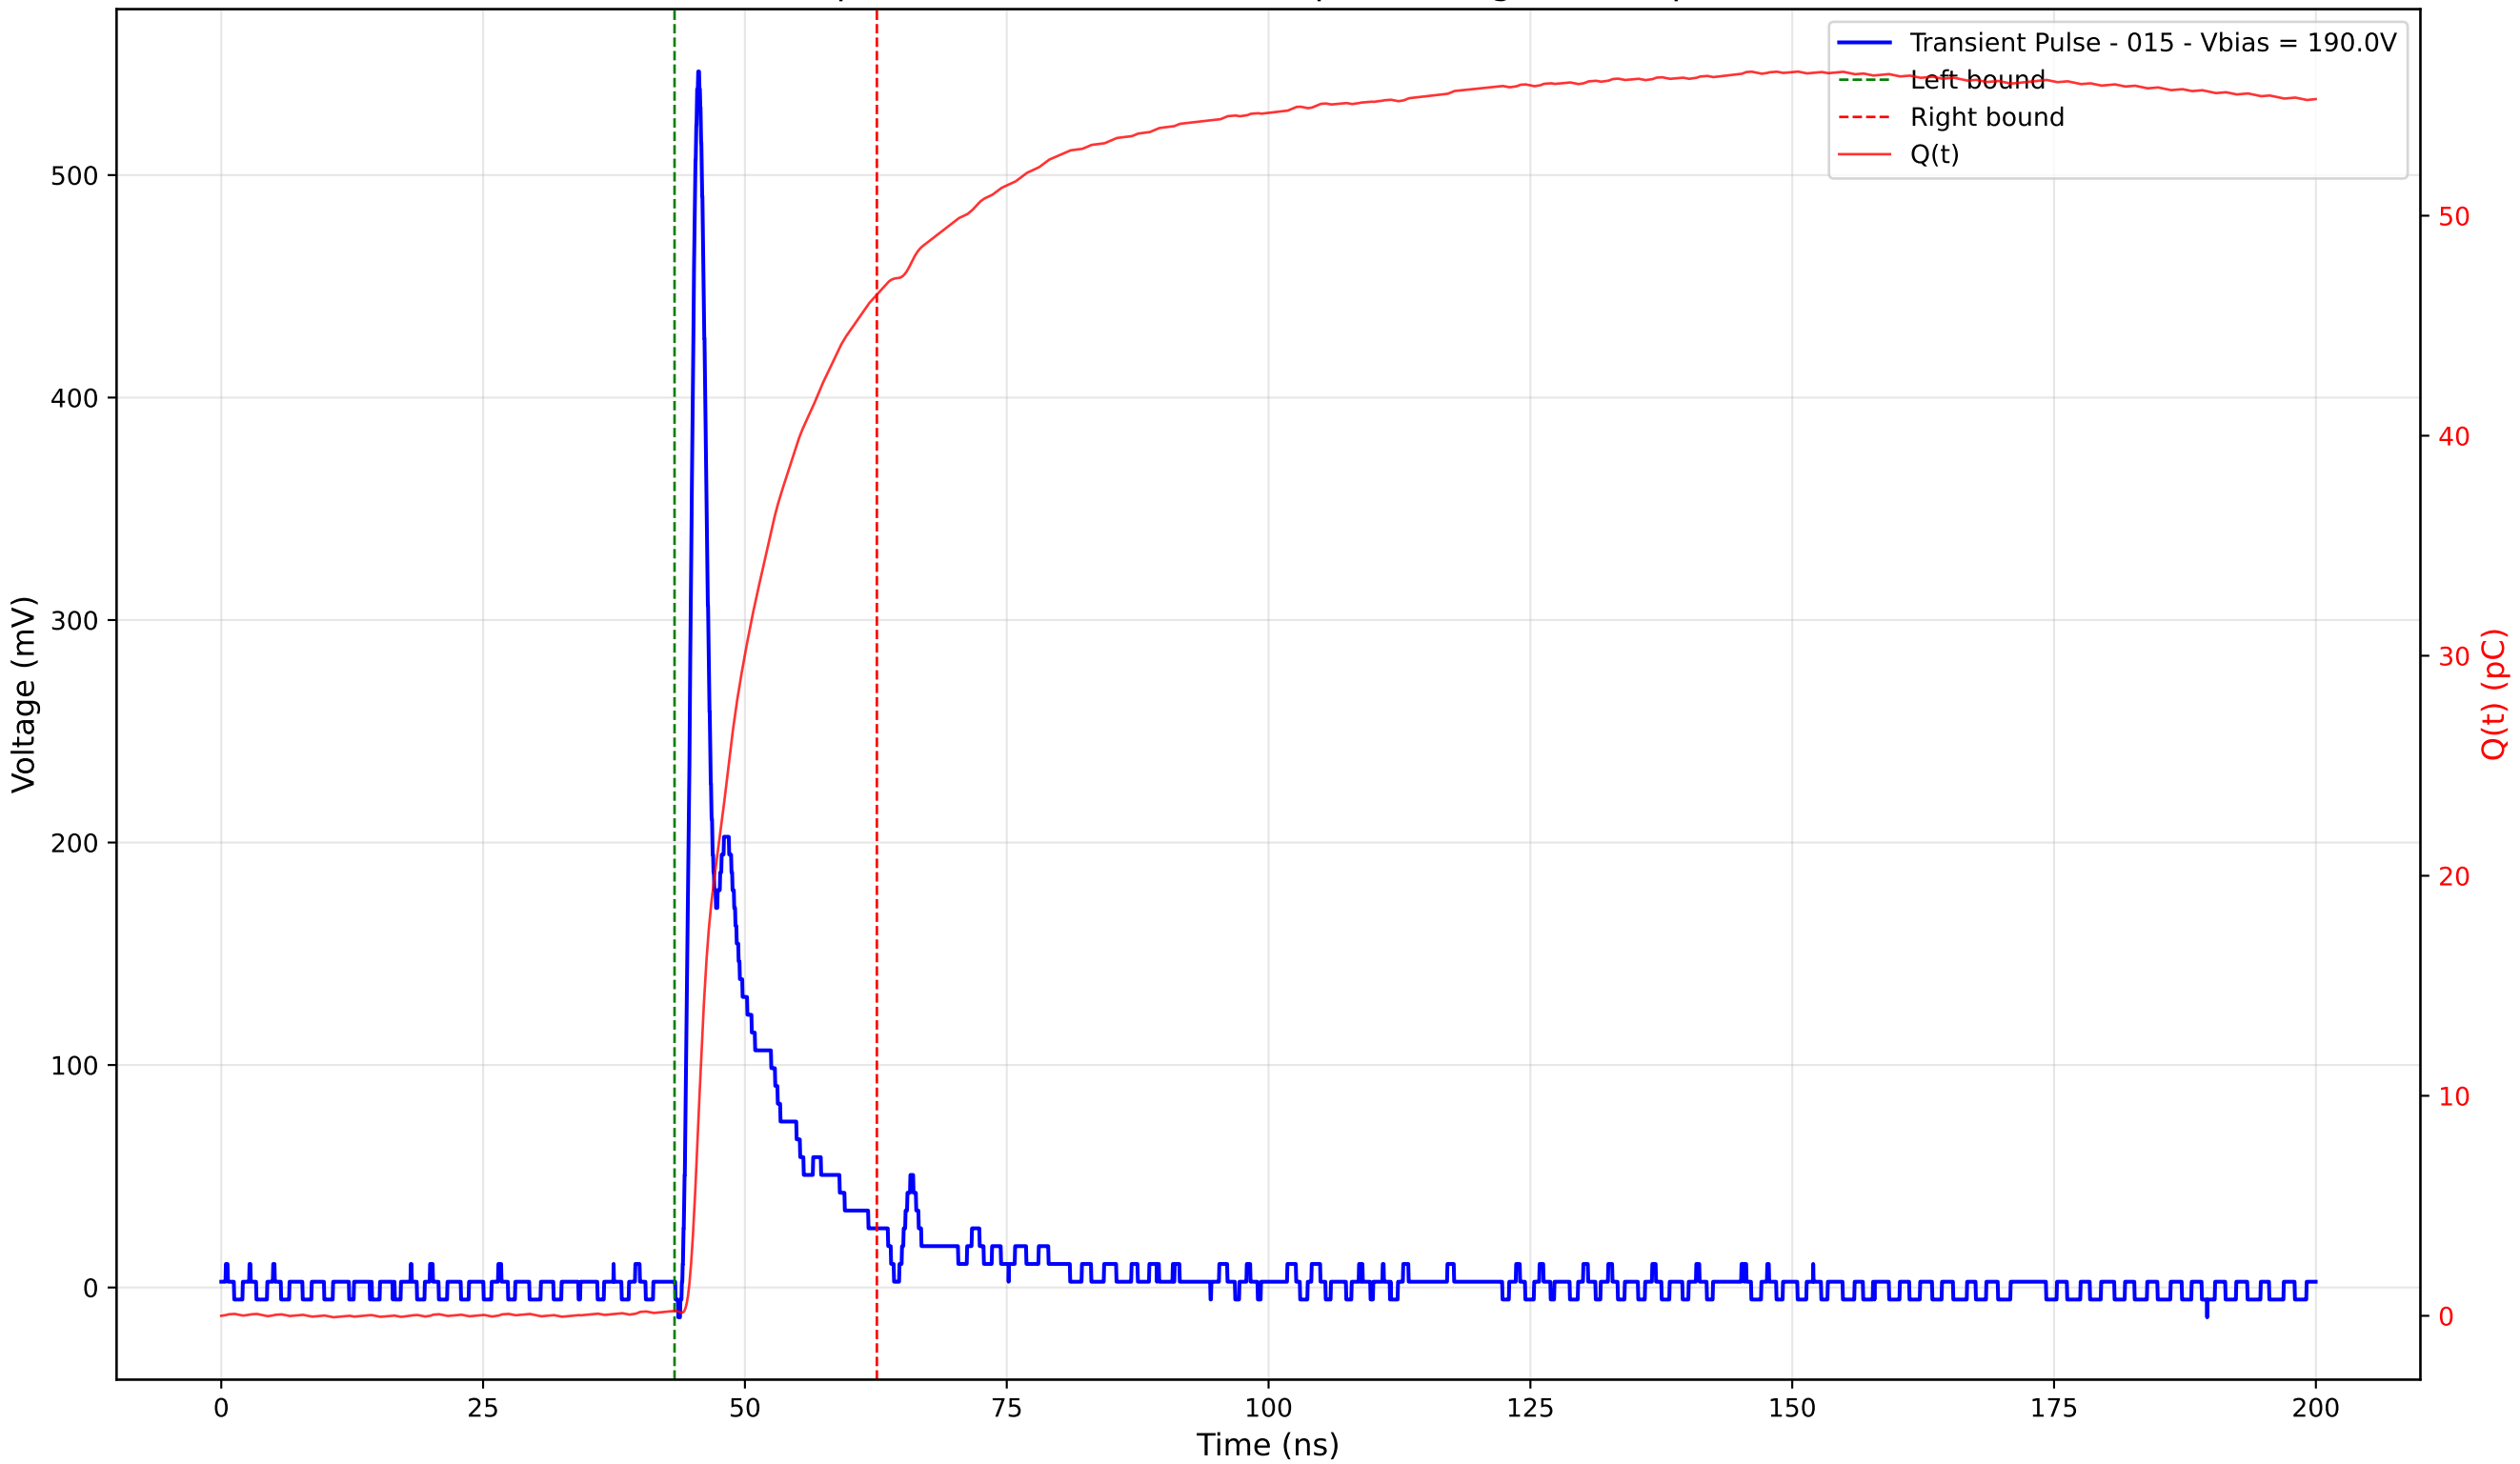


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 46.42 pC - Rise Time: 0.97 ns

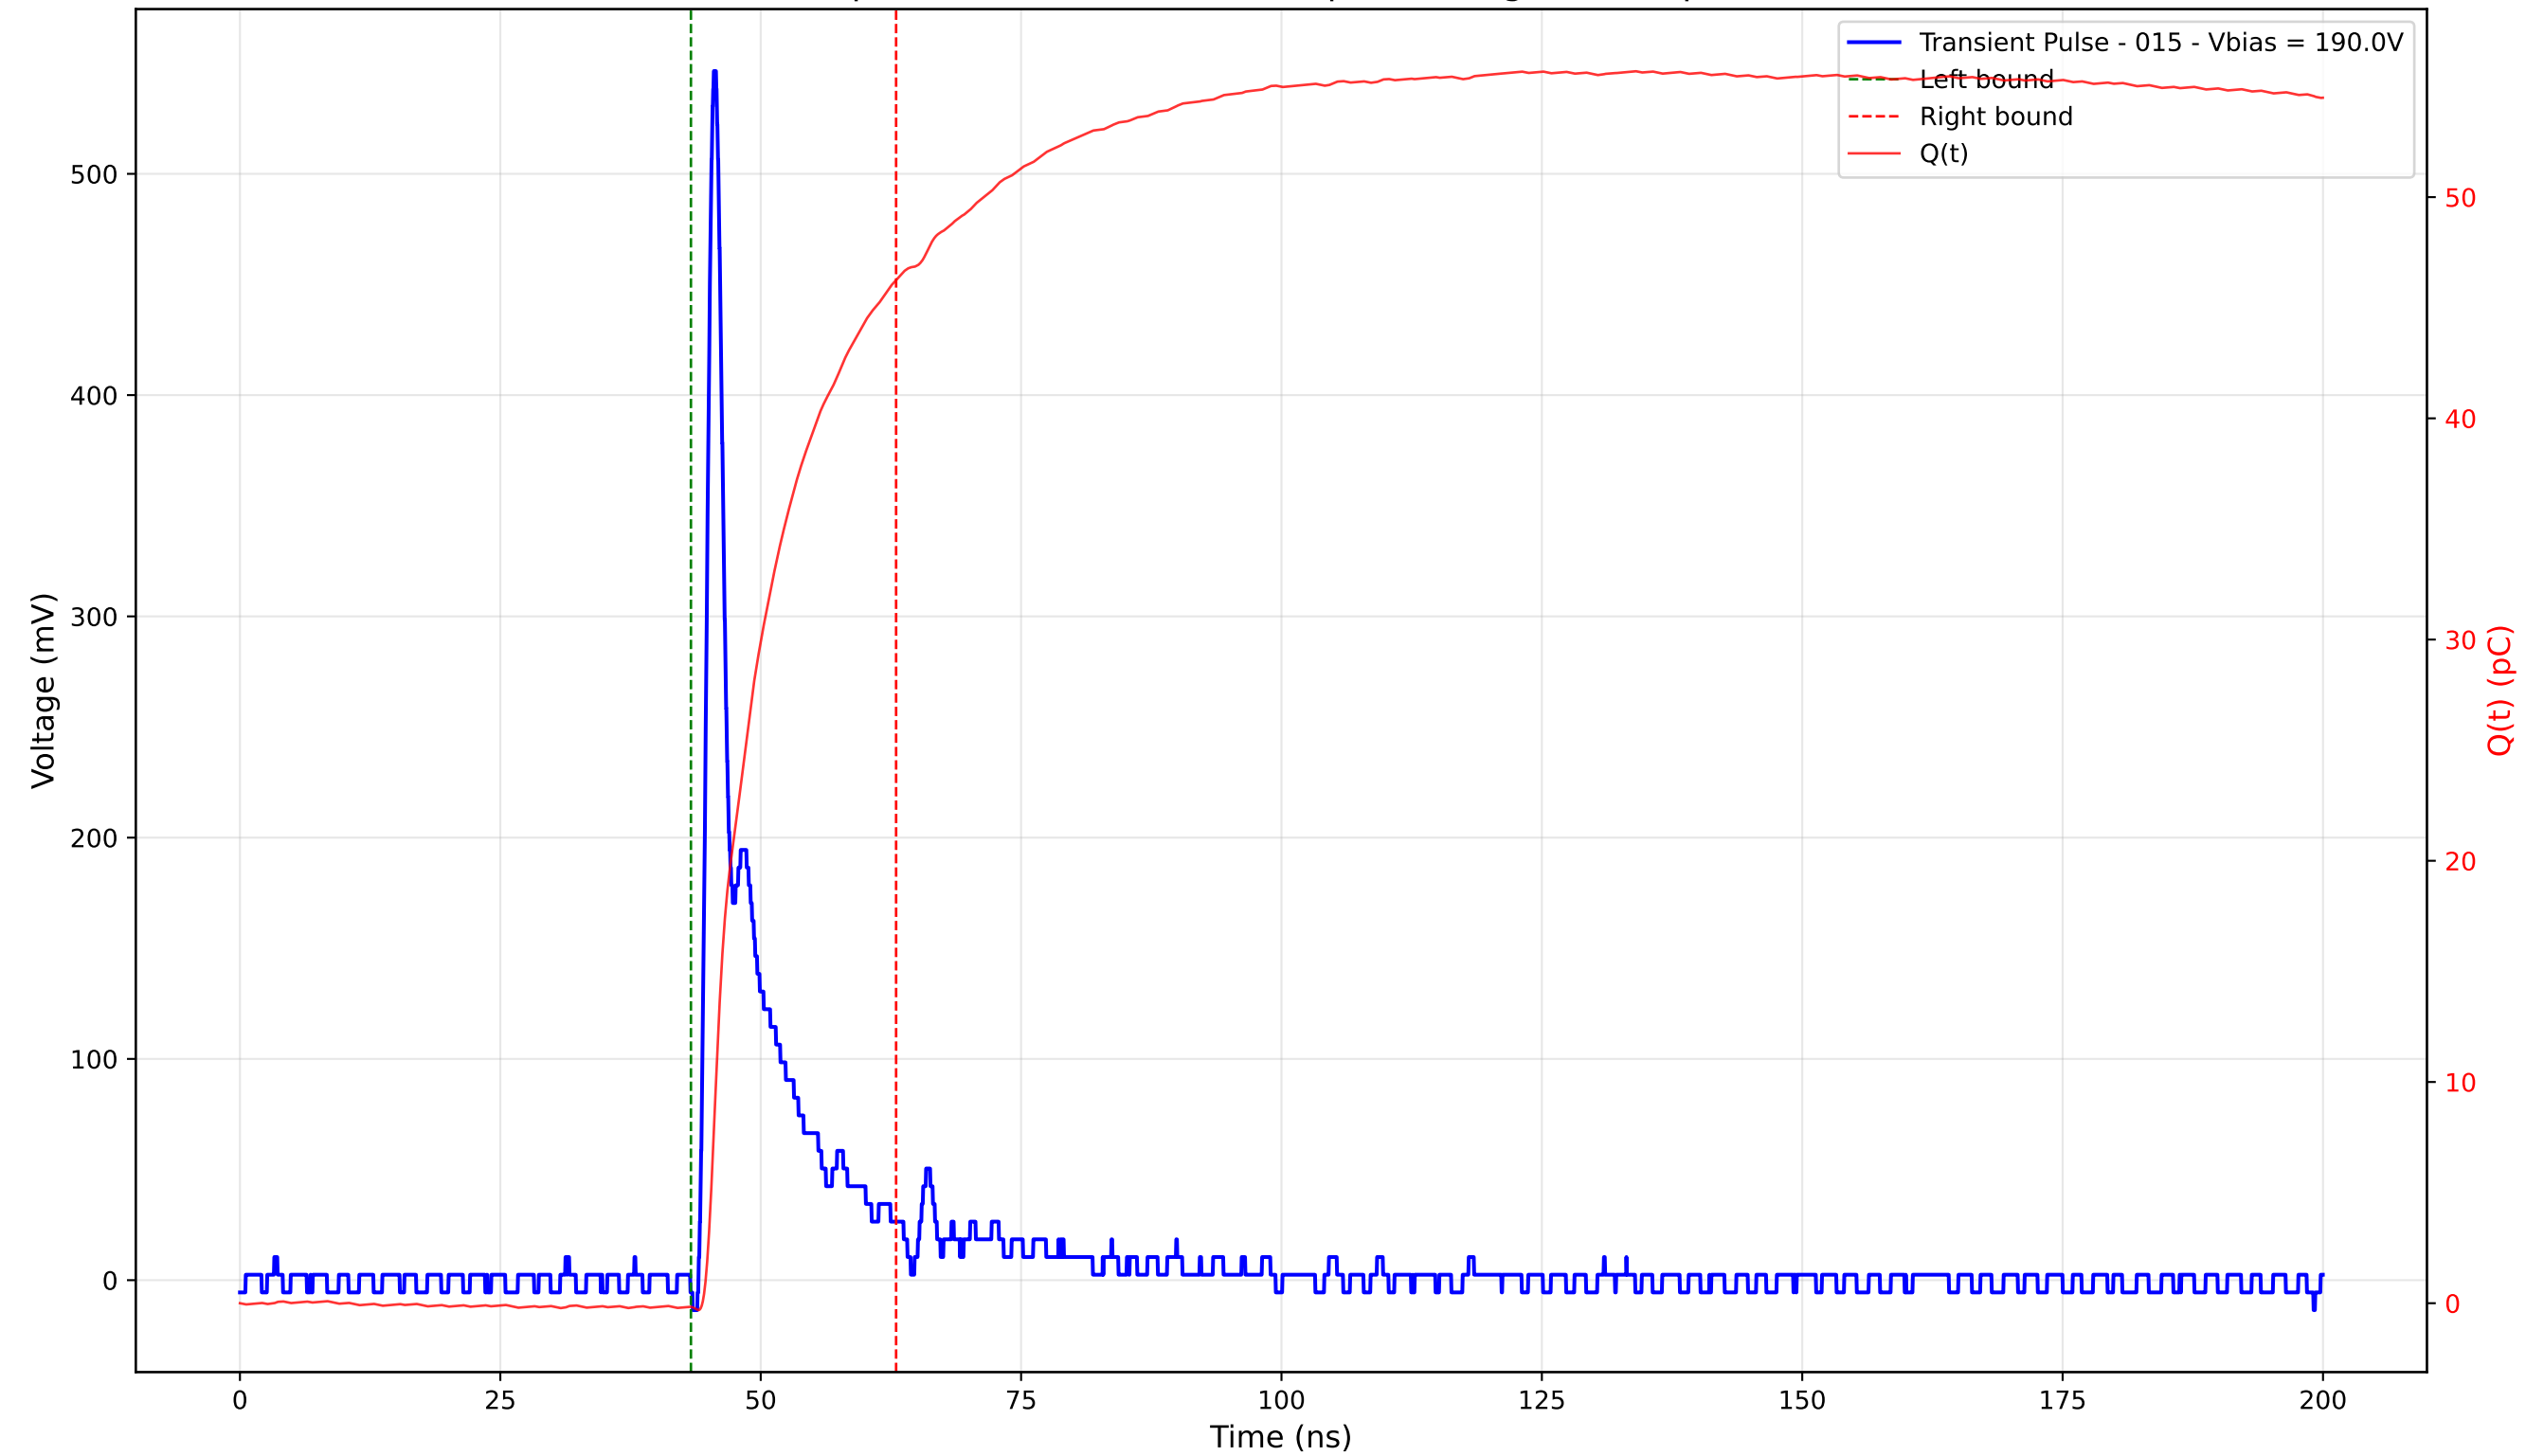


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 44.96 pC - Rise Time: 0.97 ns

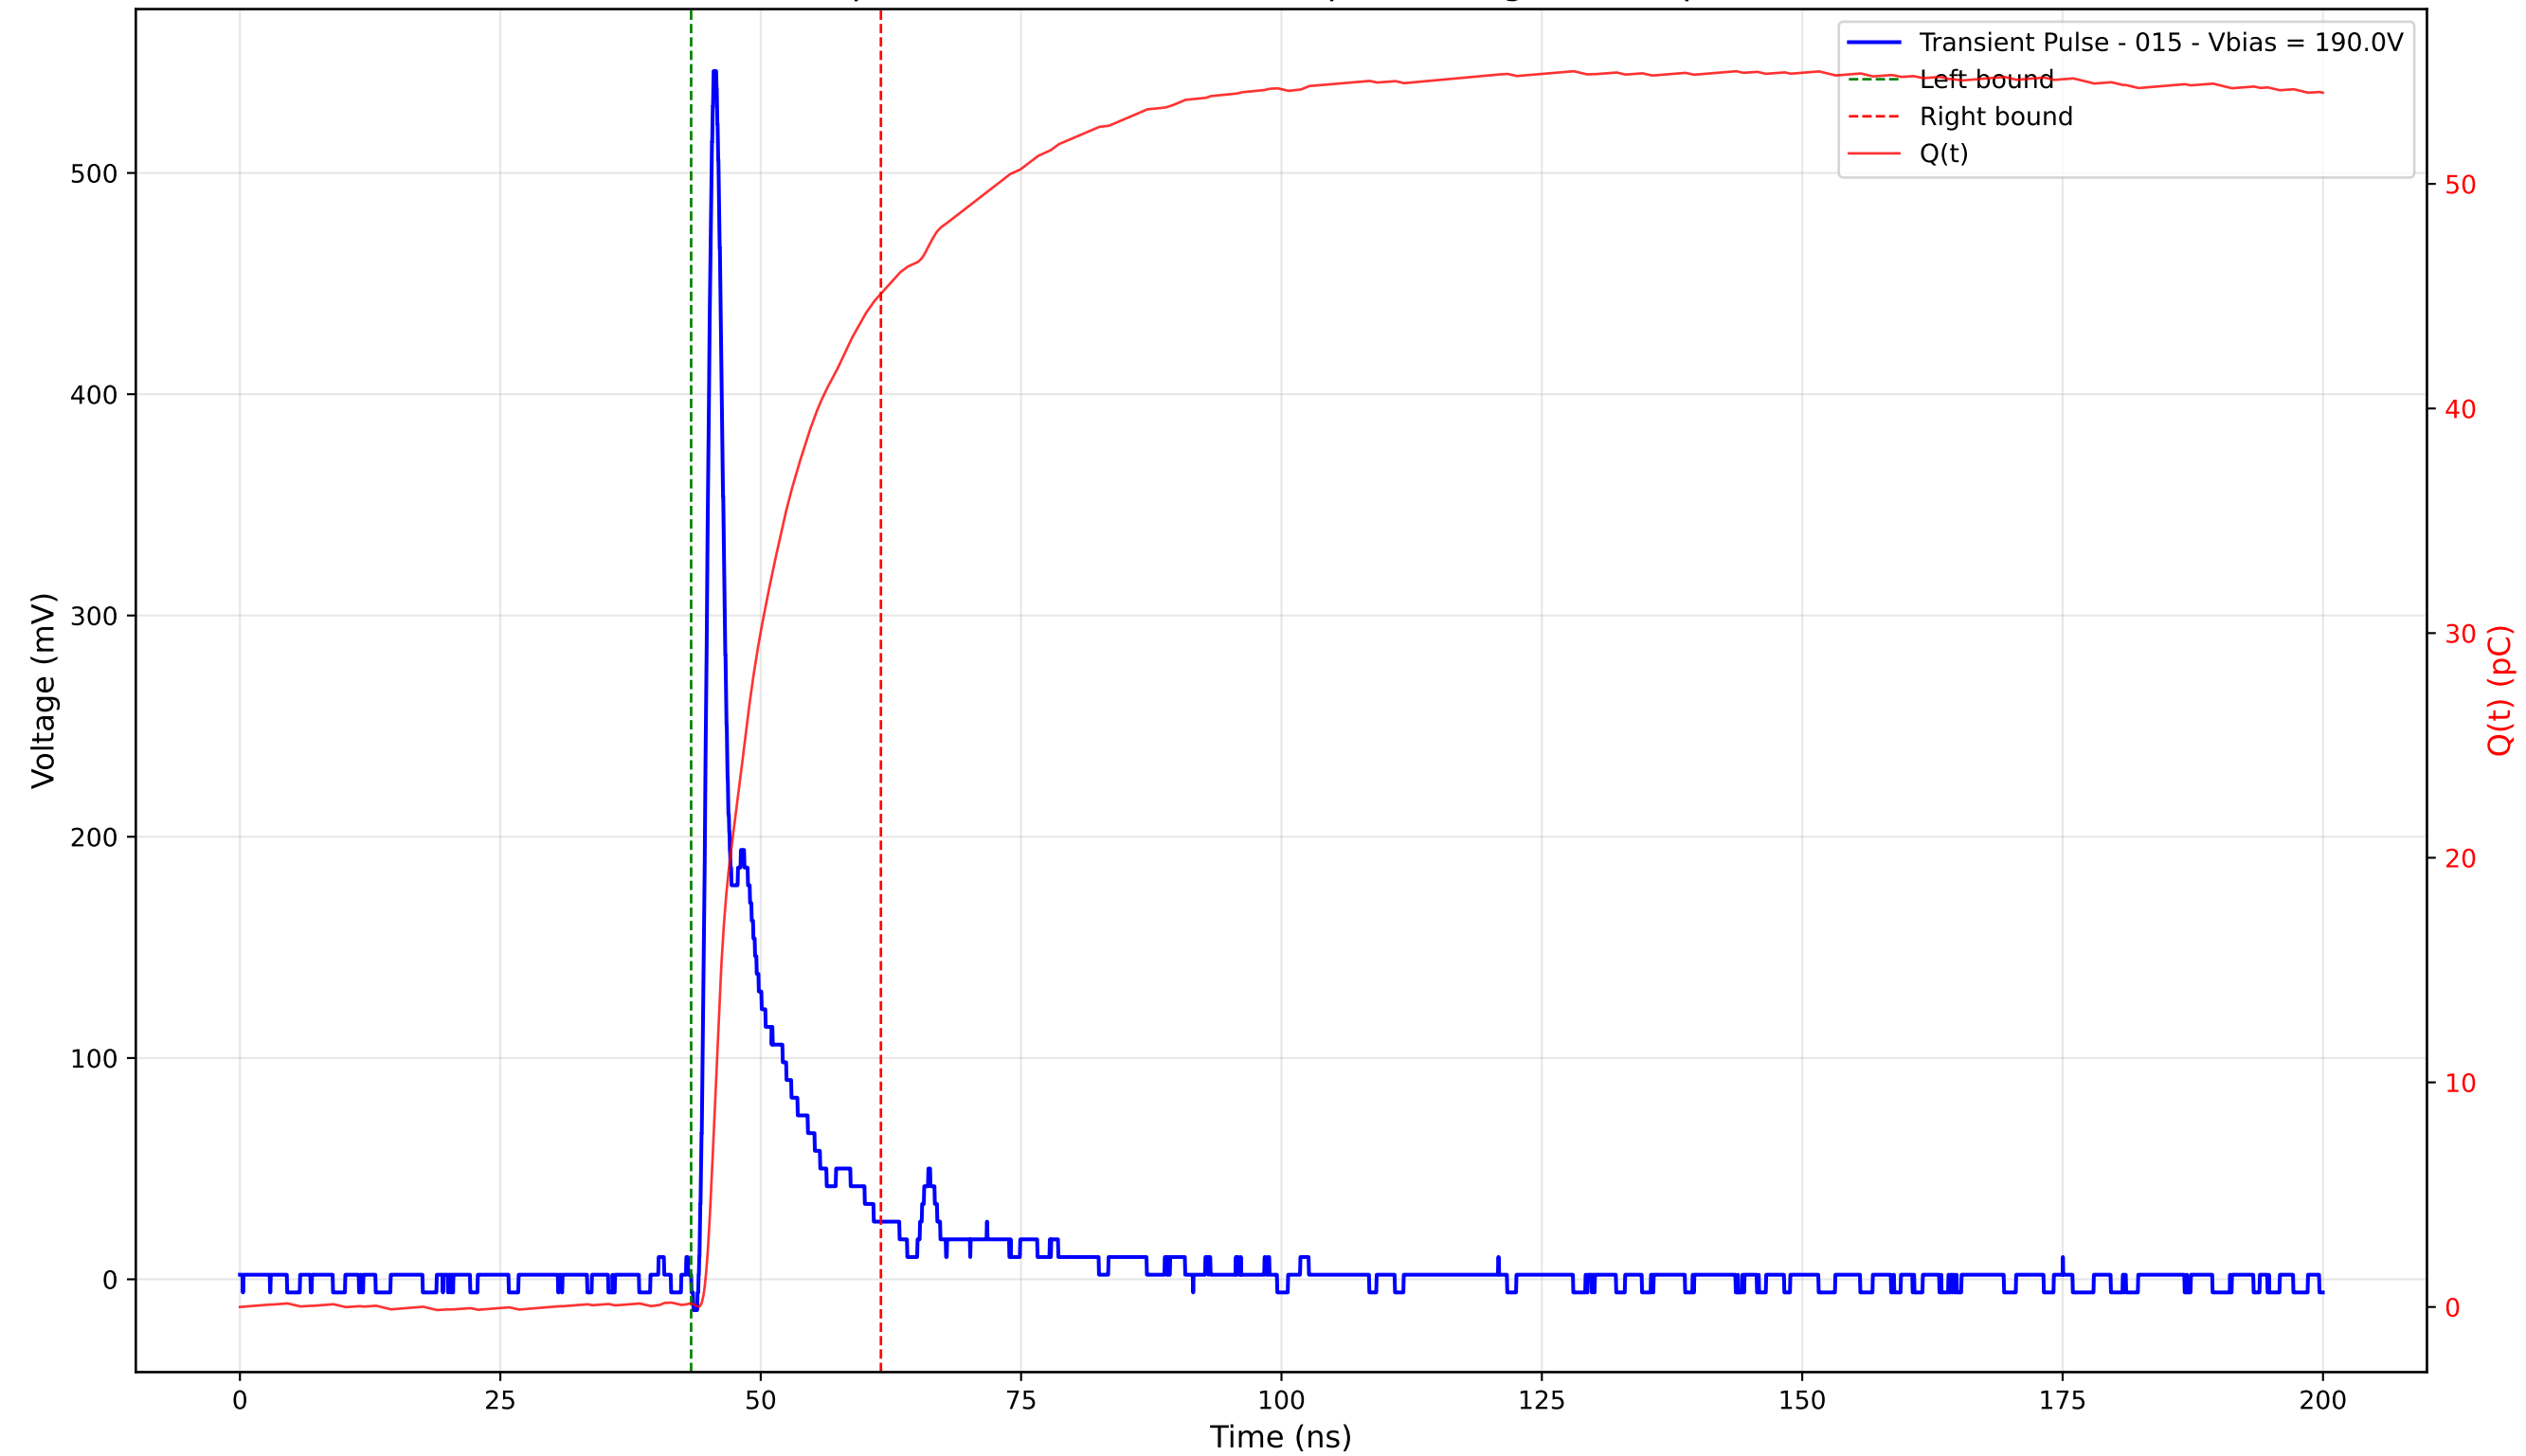


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 46.01 pC - Rise Time: 0.99 ns

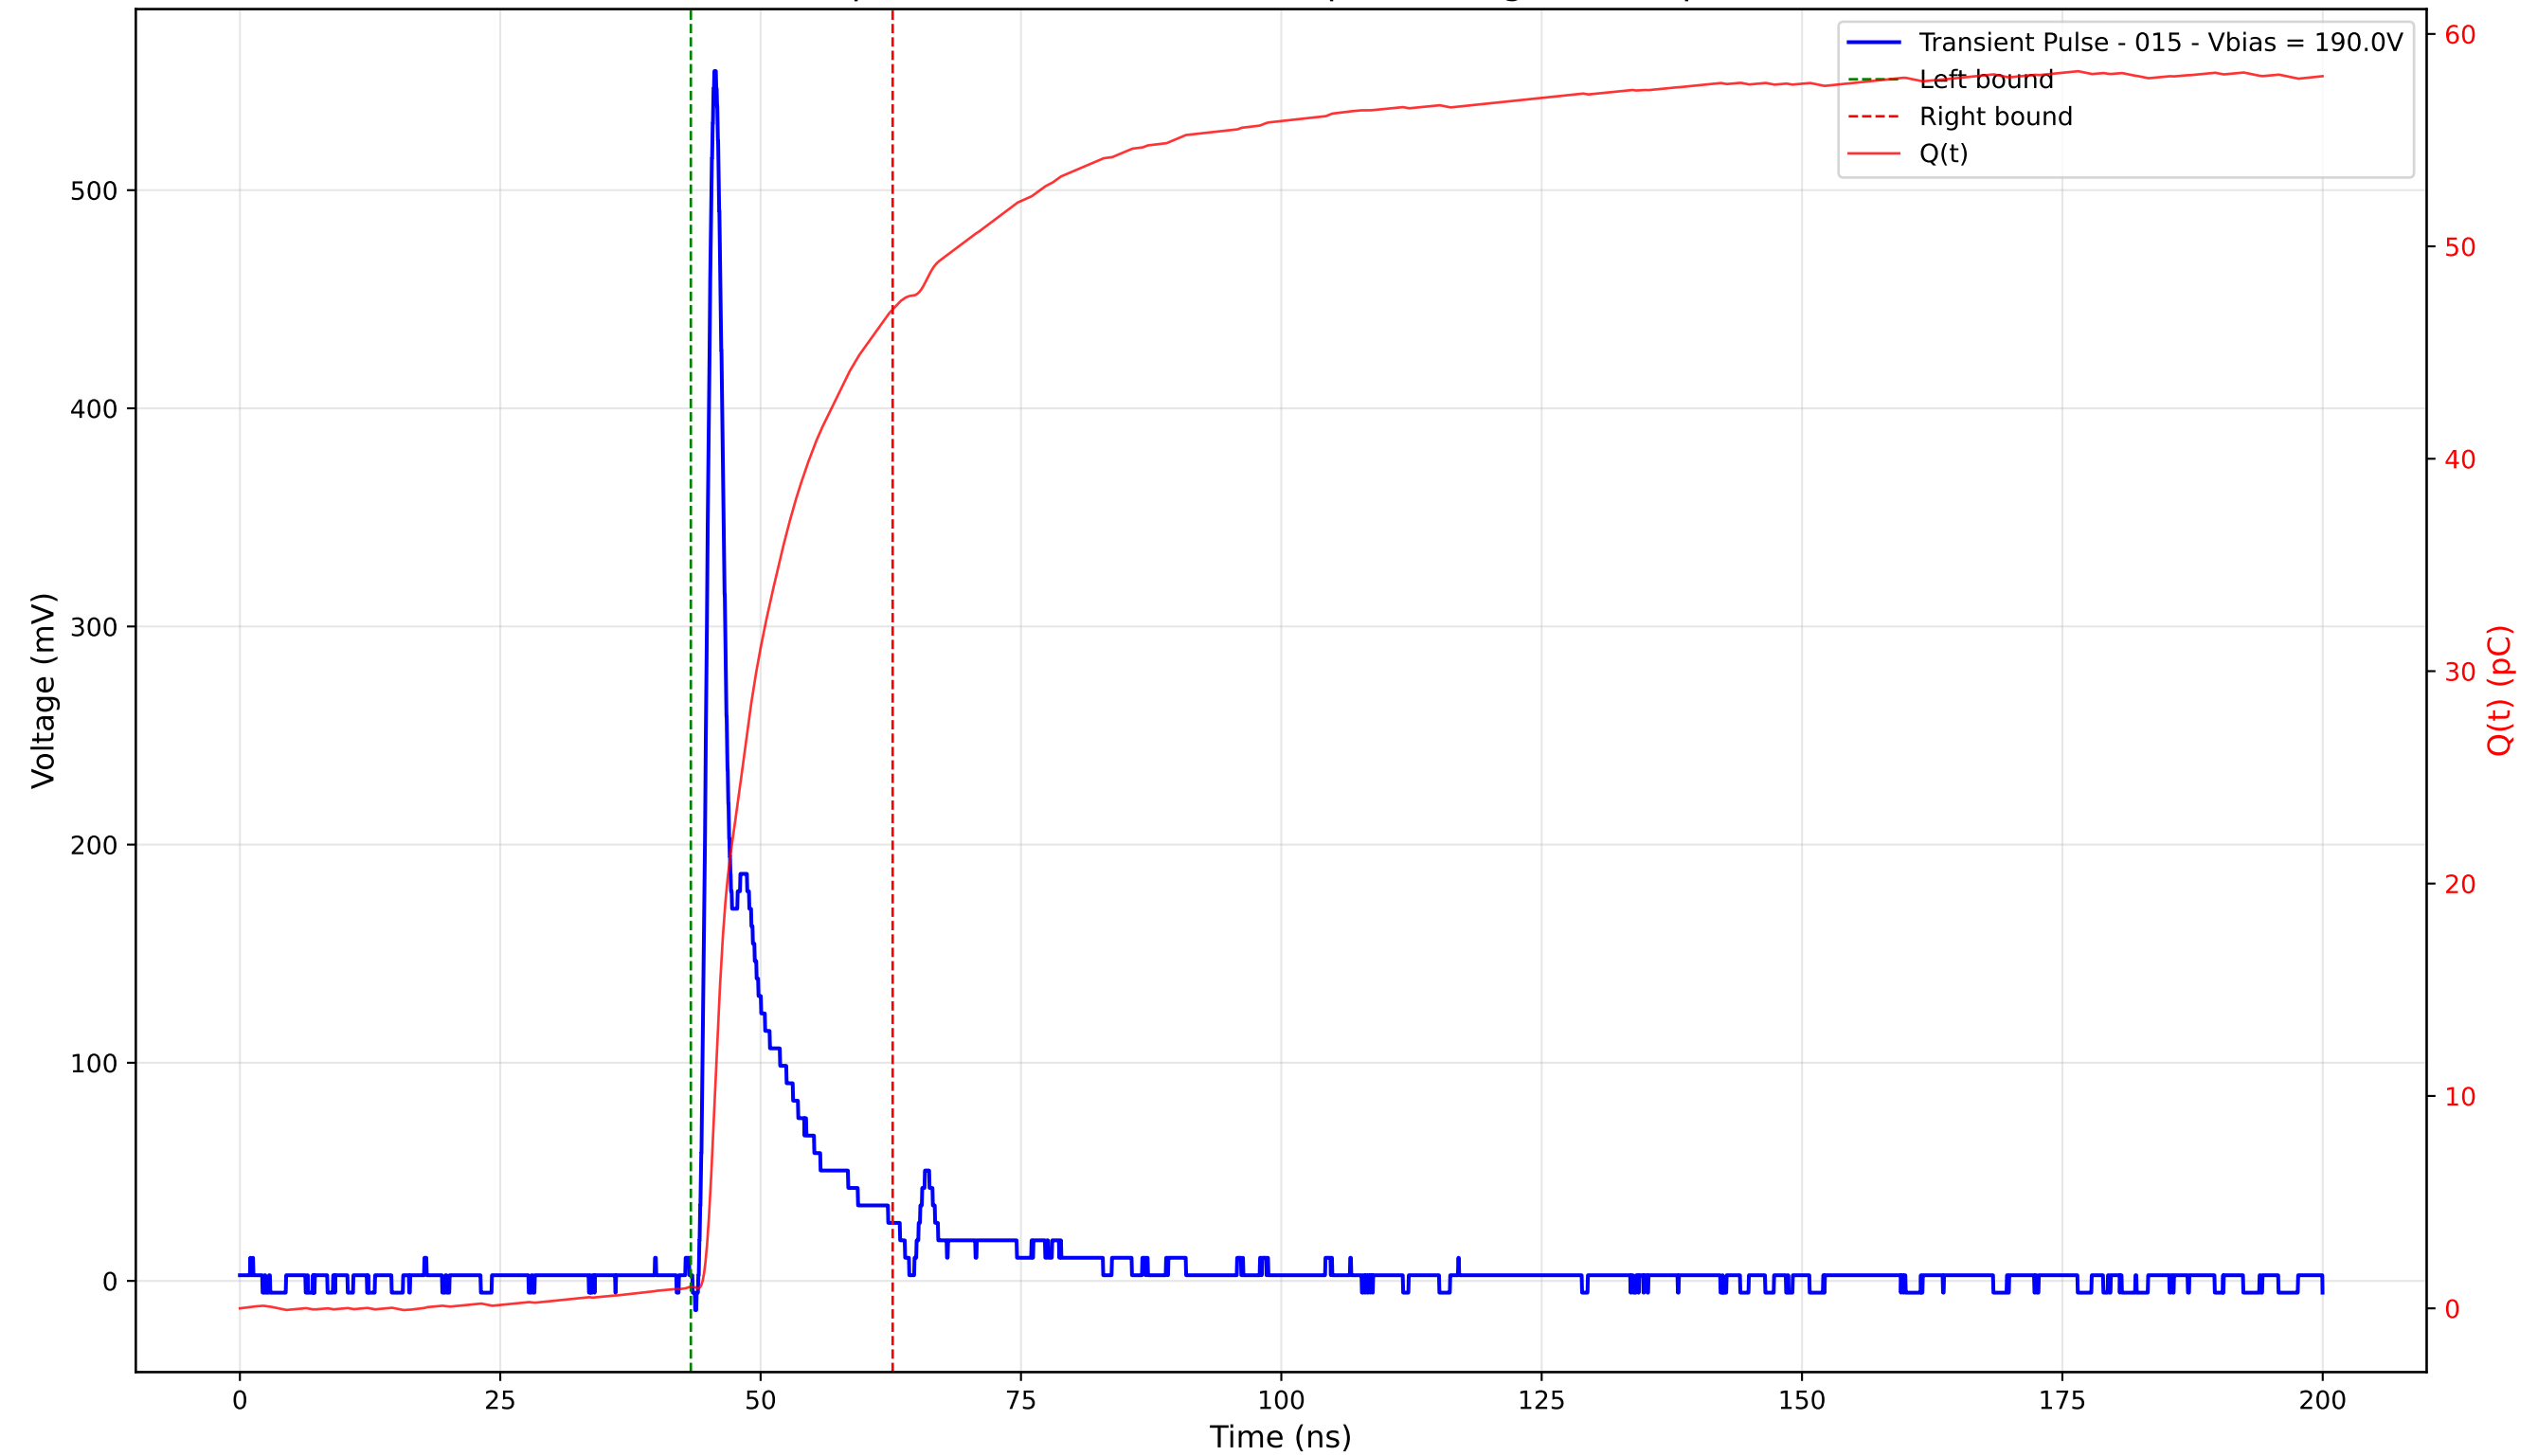


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 45.91 pC - Rise Time: 1.03 ns

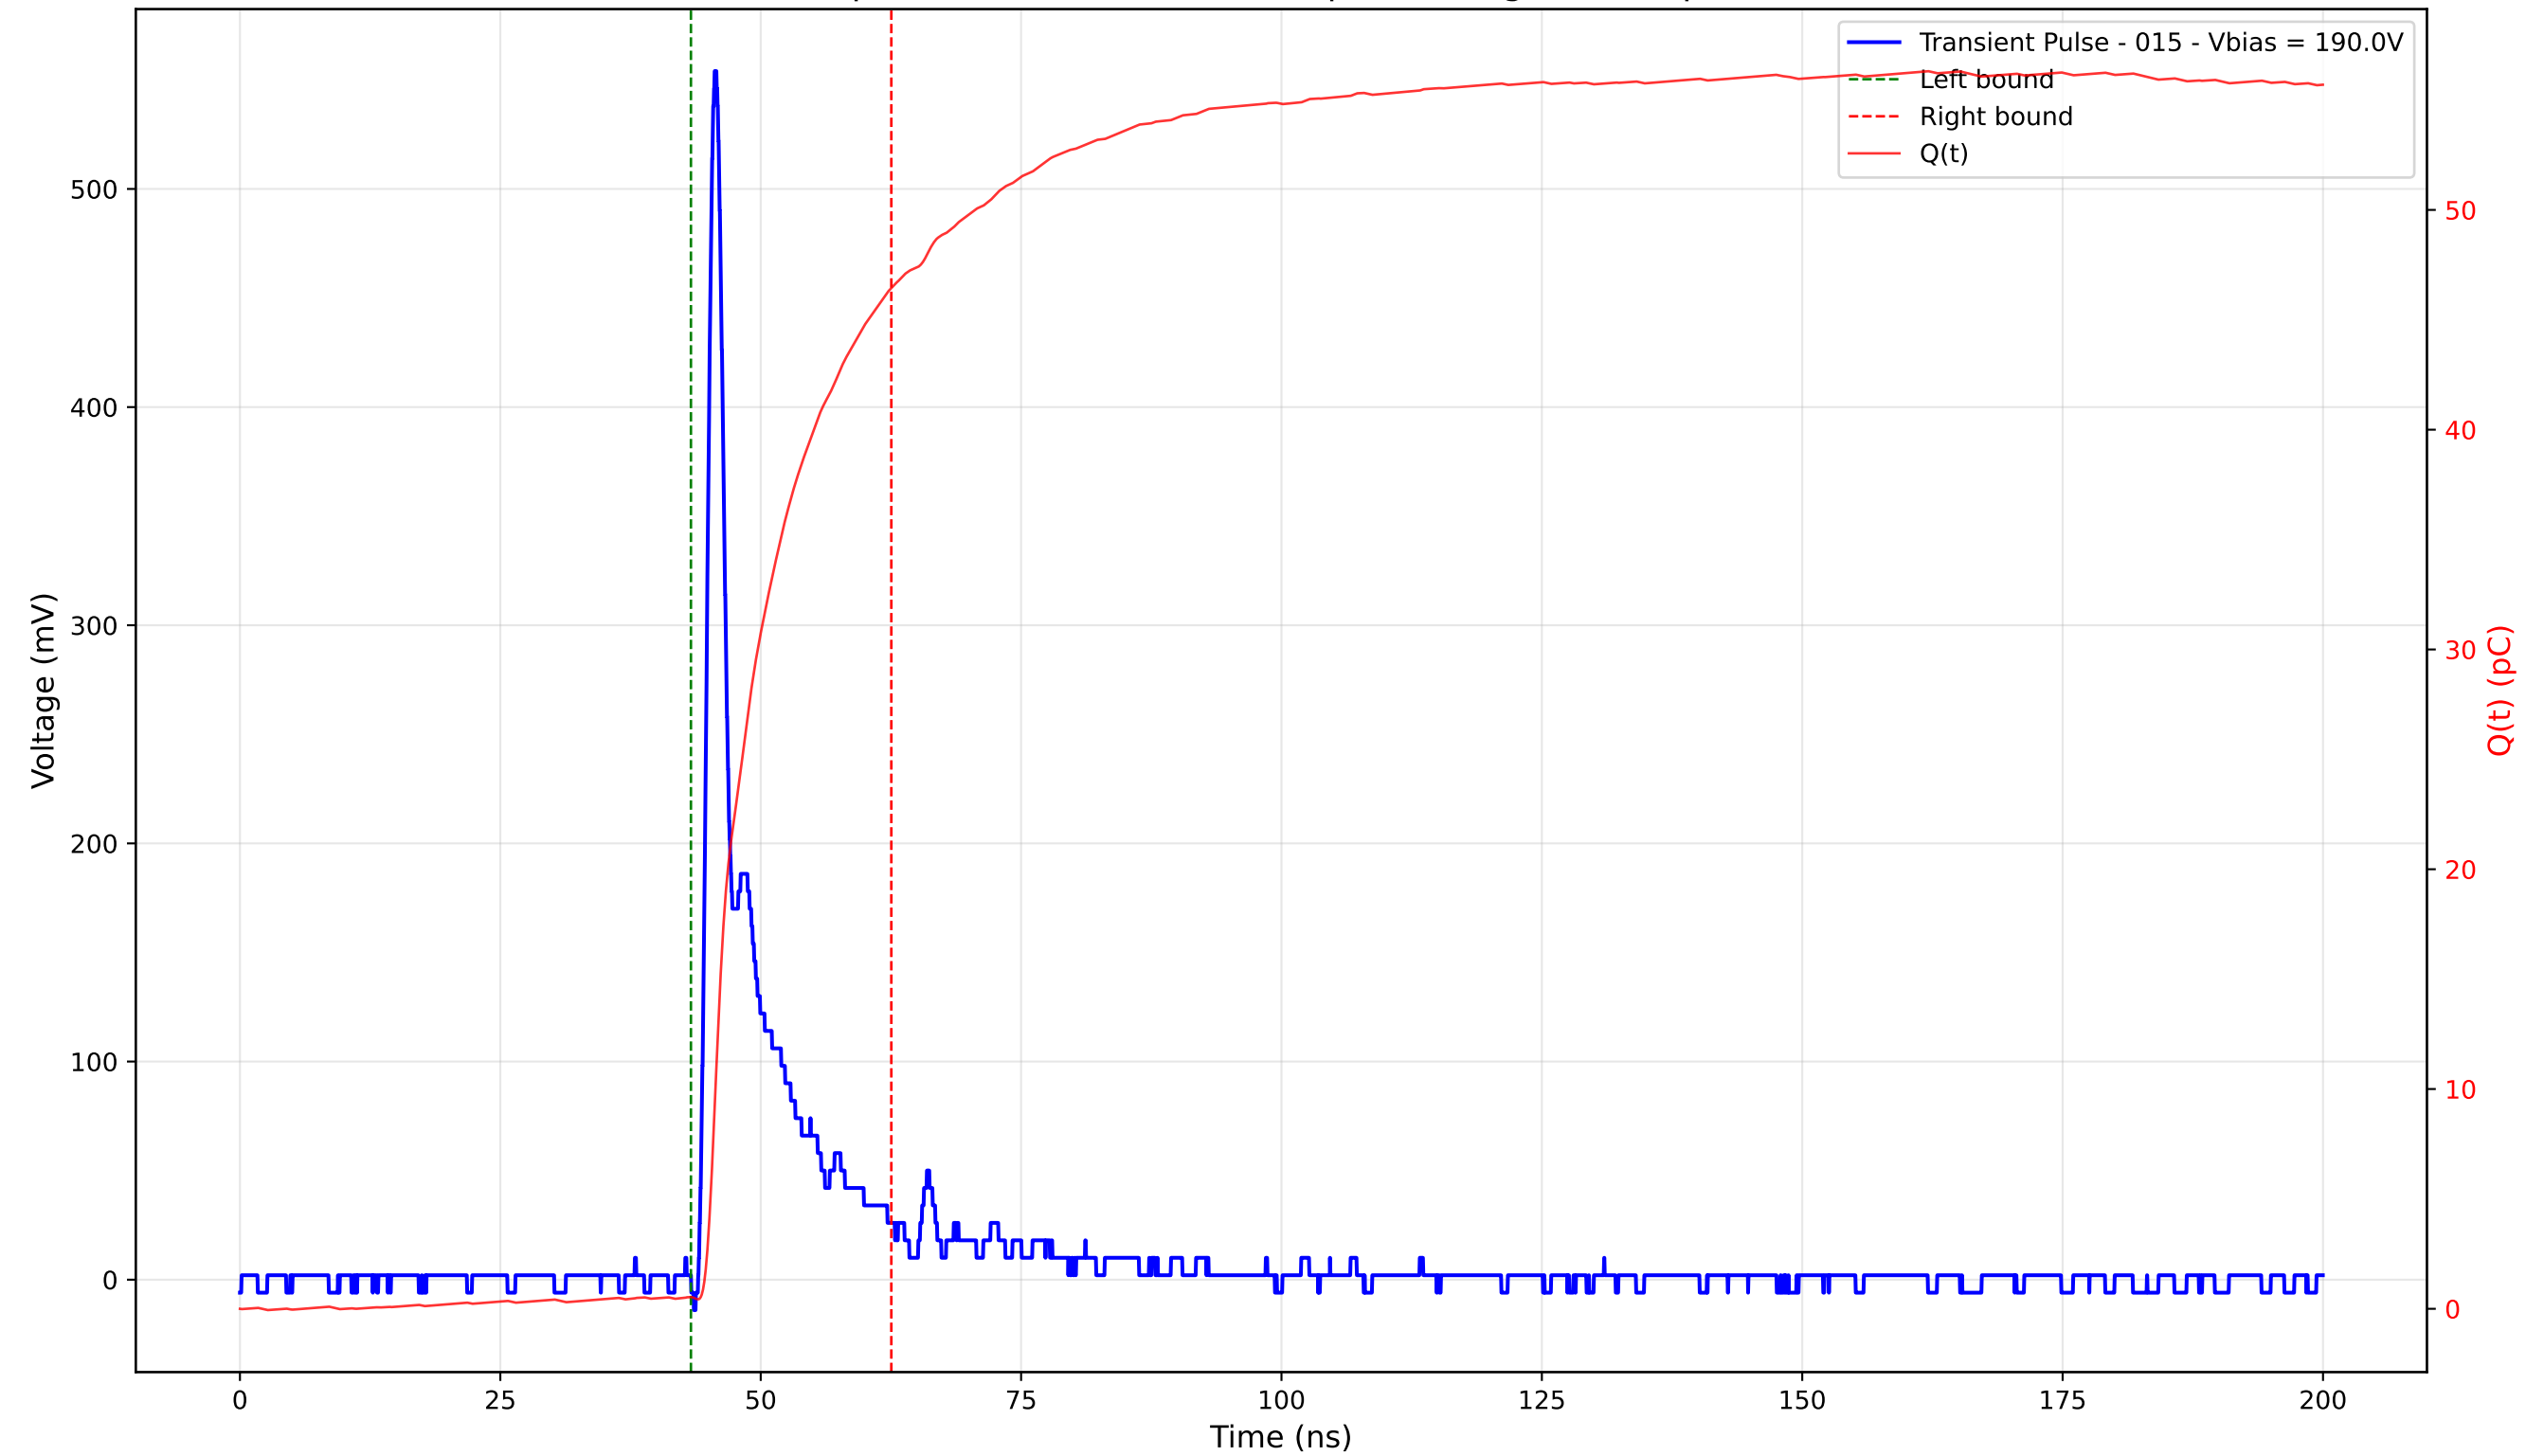


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 45.40 pC - Rise Time: 1.00 ns

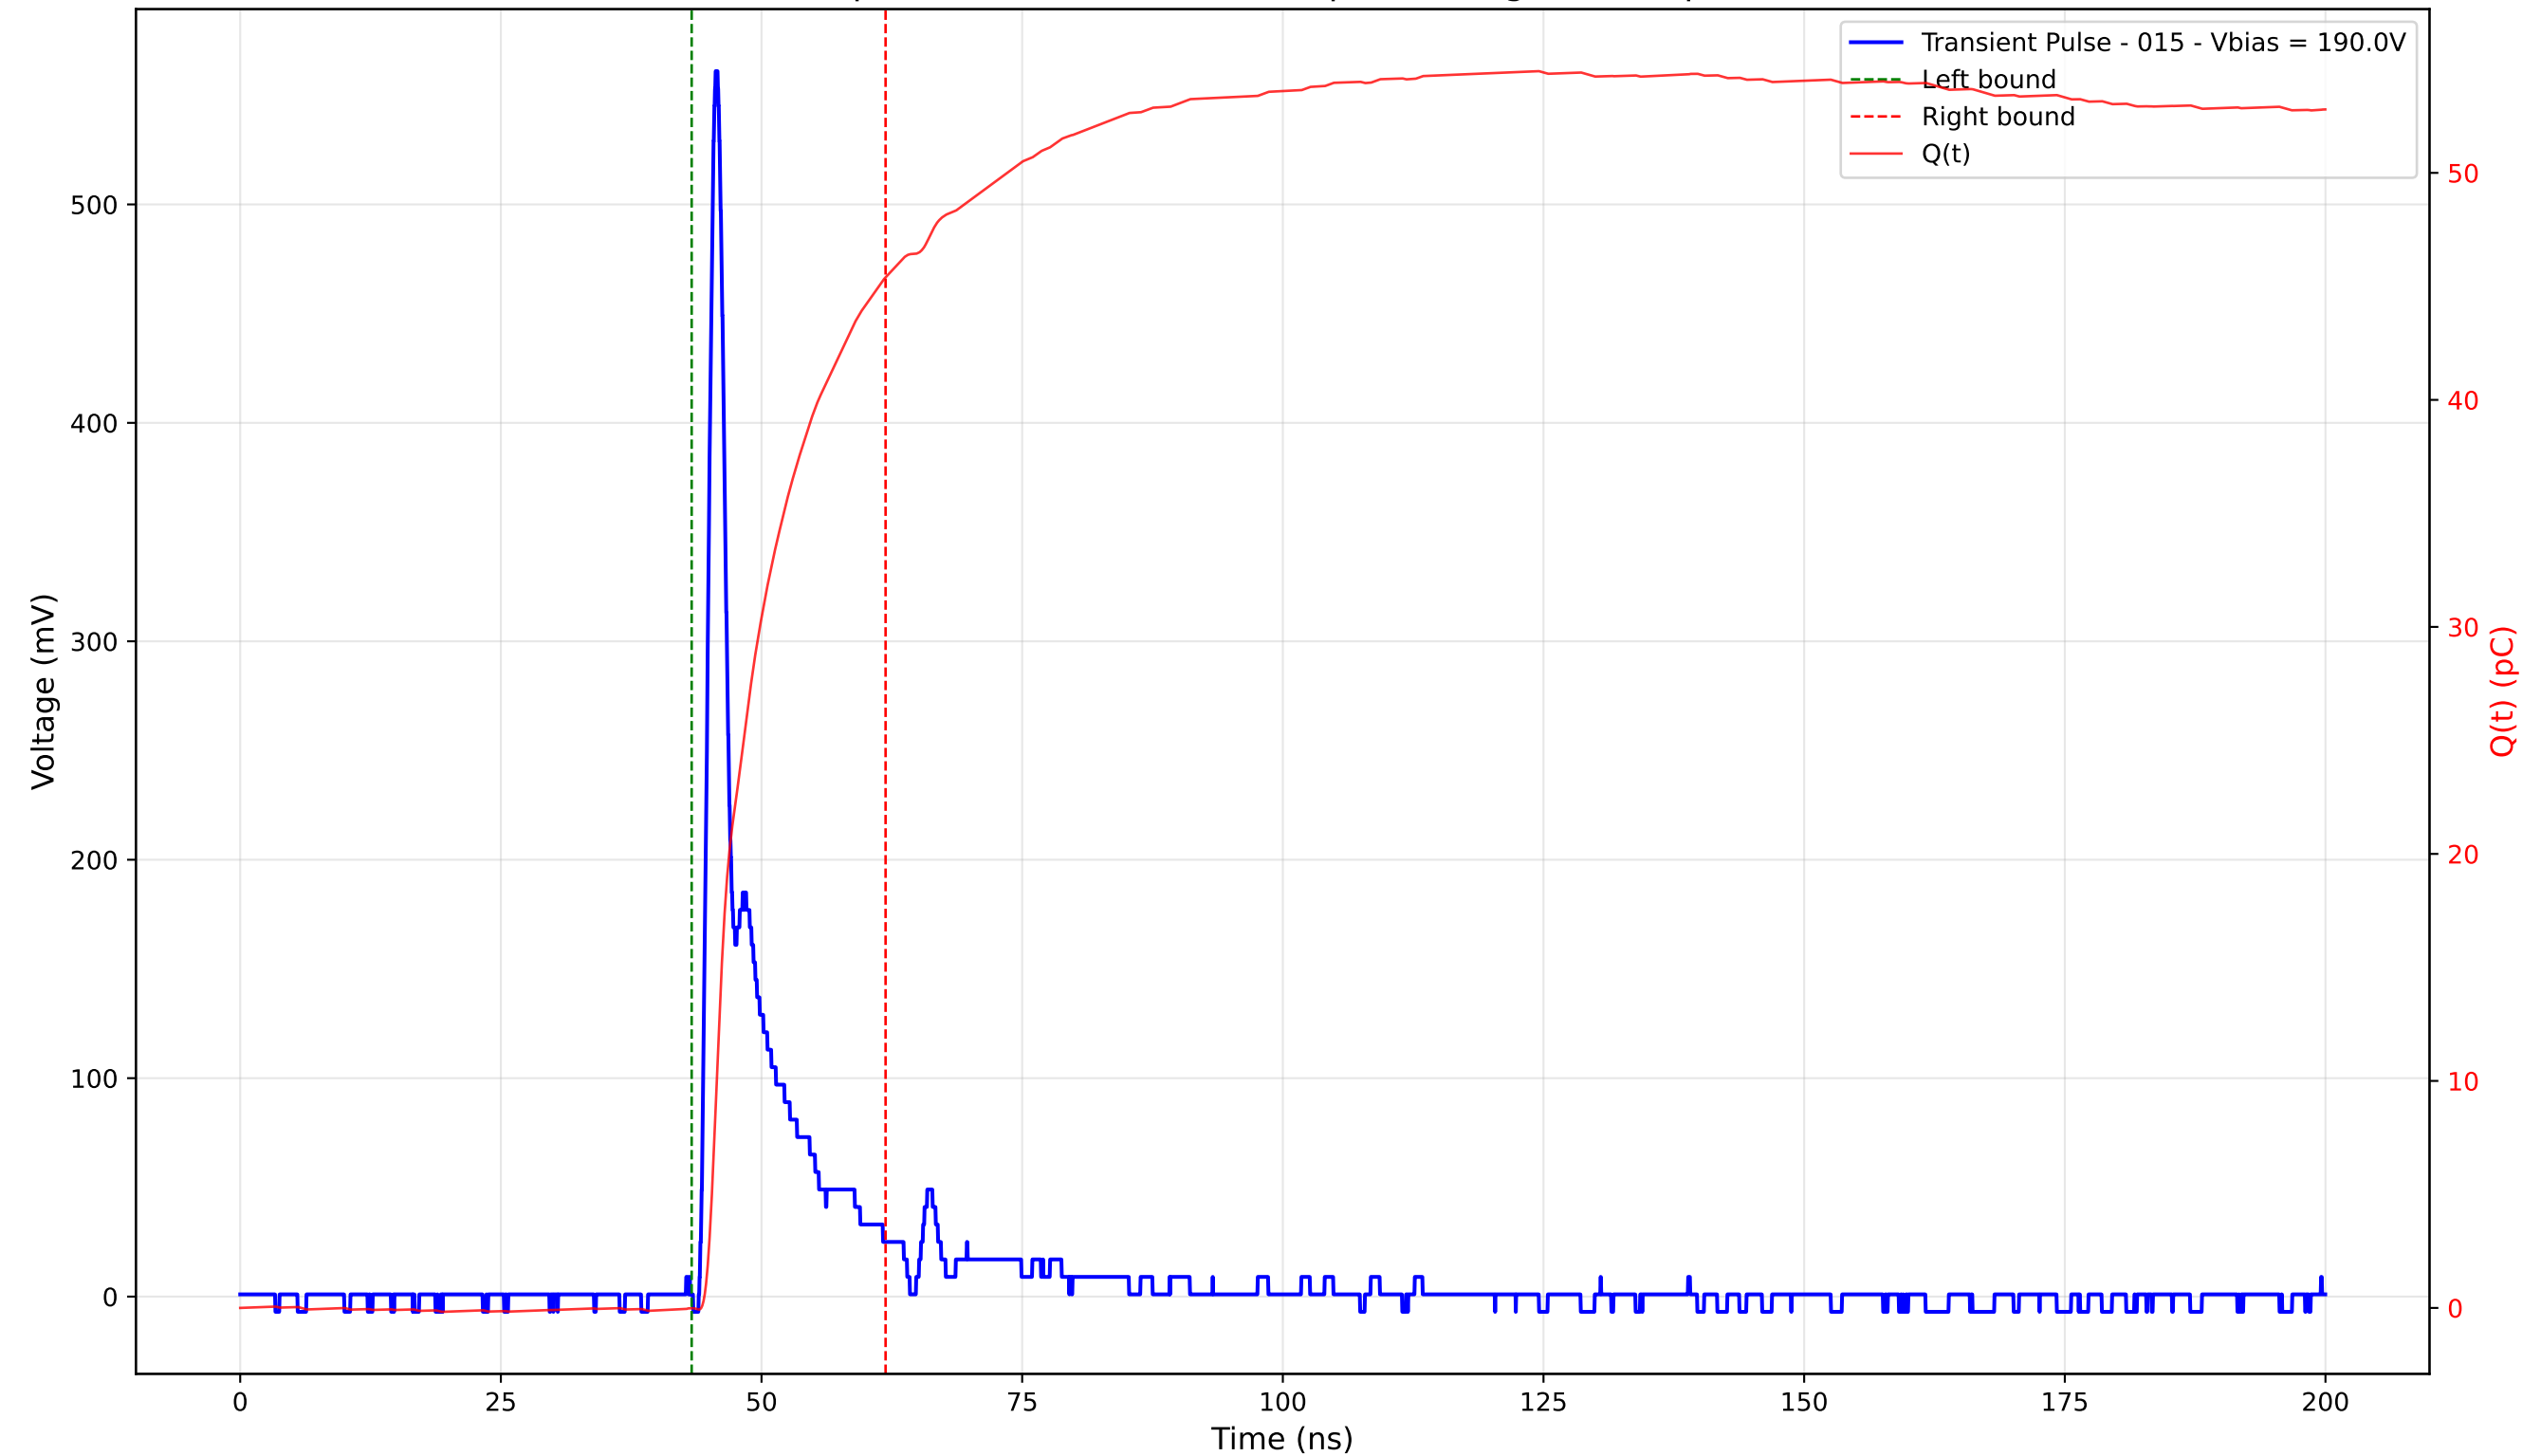


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 44.37 pC - Rise Time: 1.03 ns

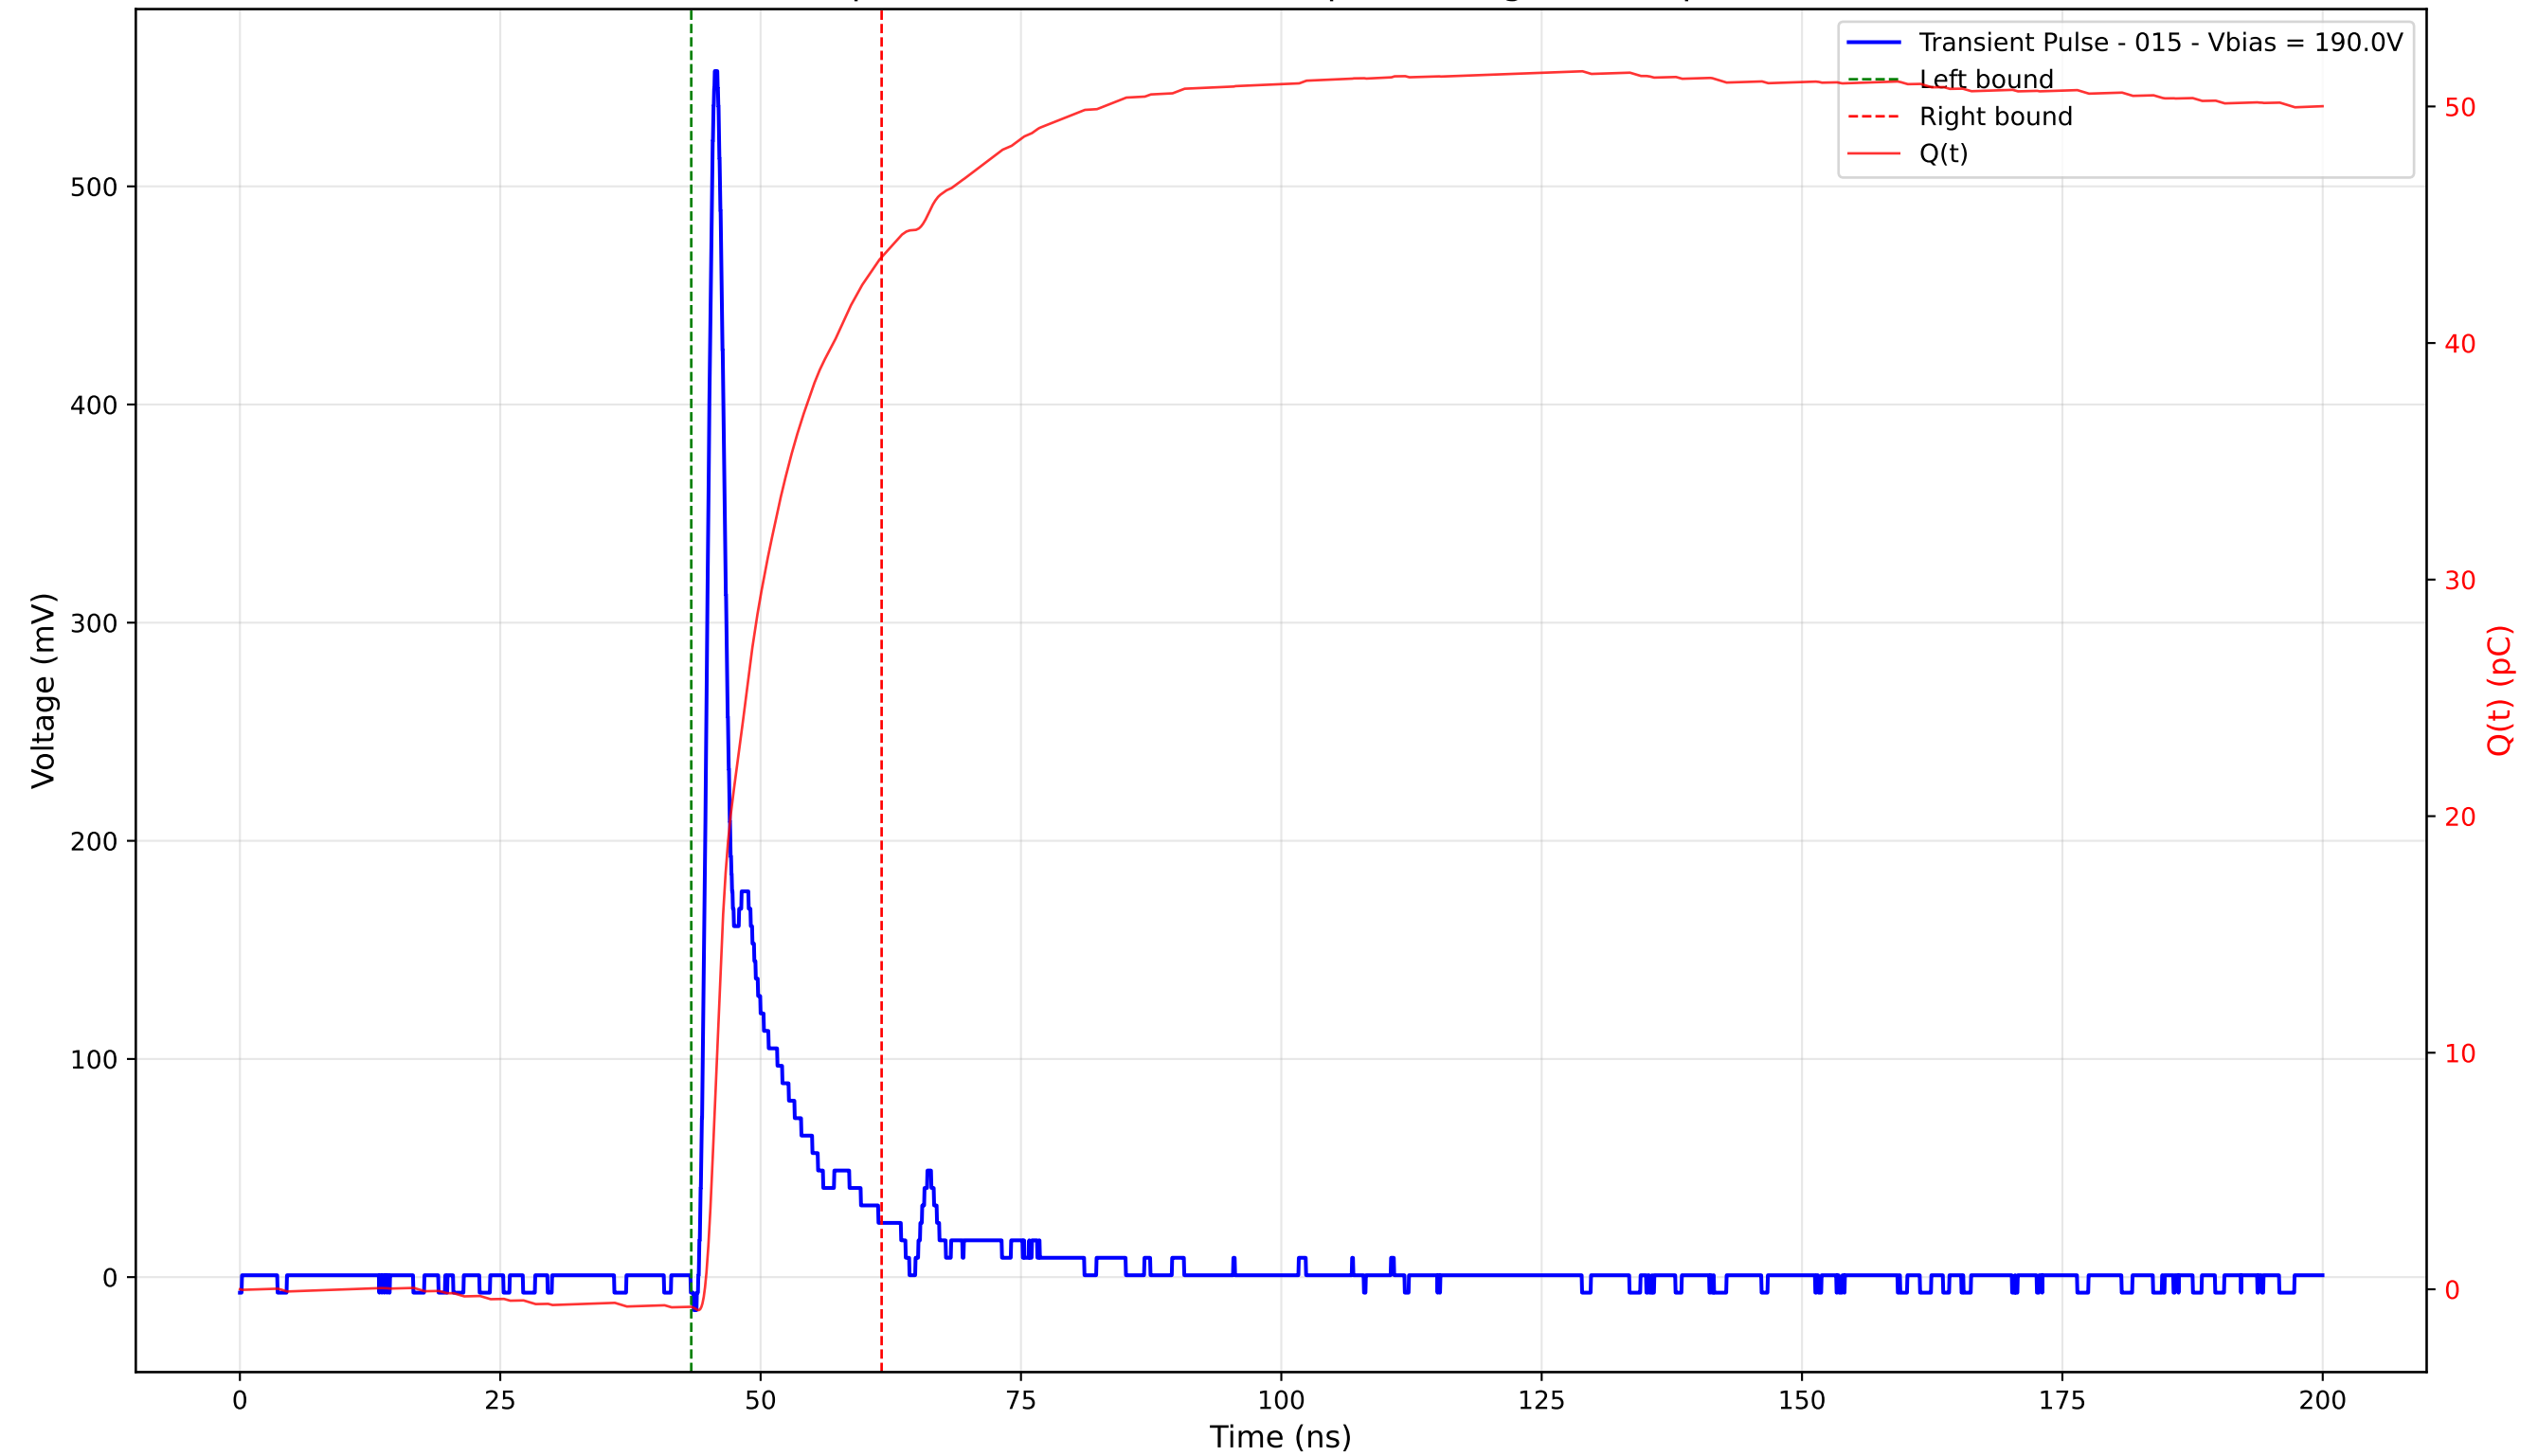


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 45.54 pC - Rise Time: 1.07 ns

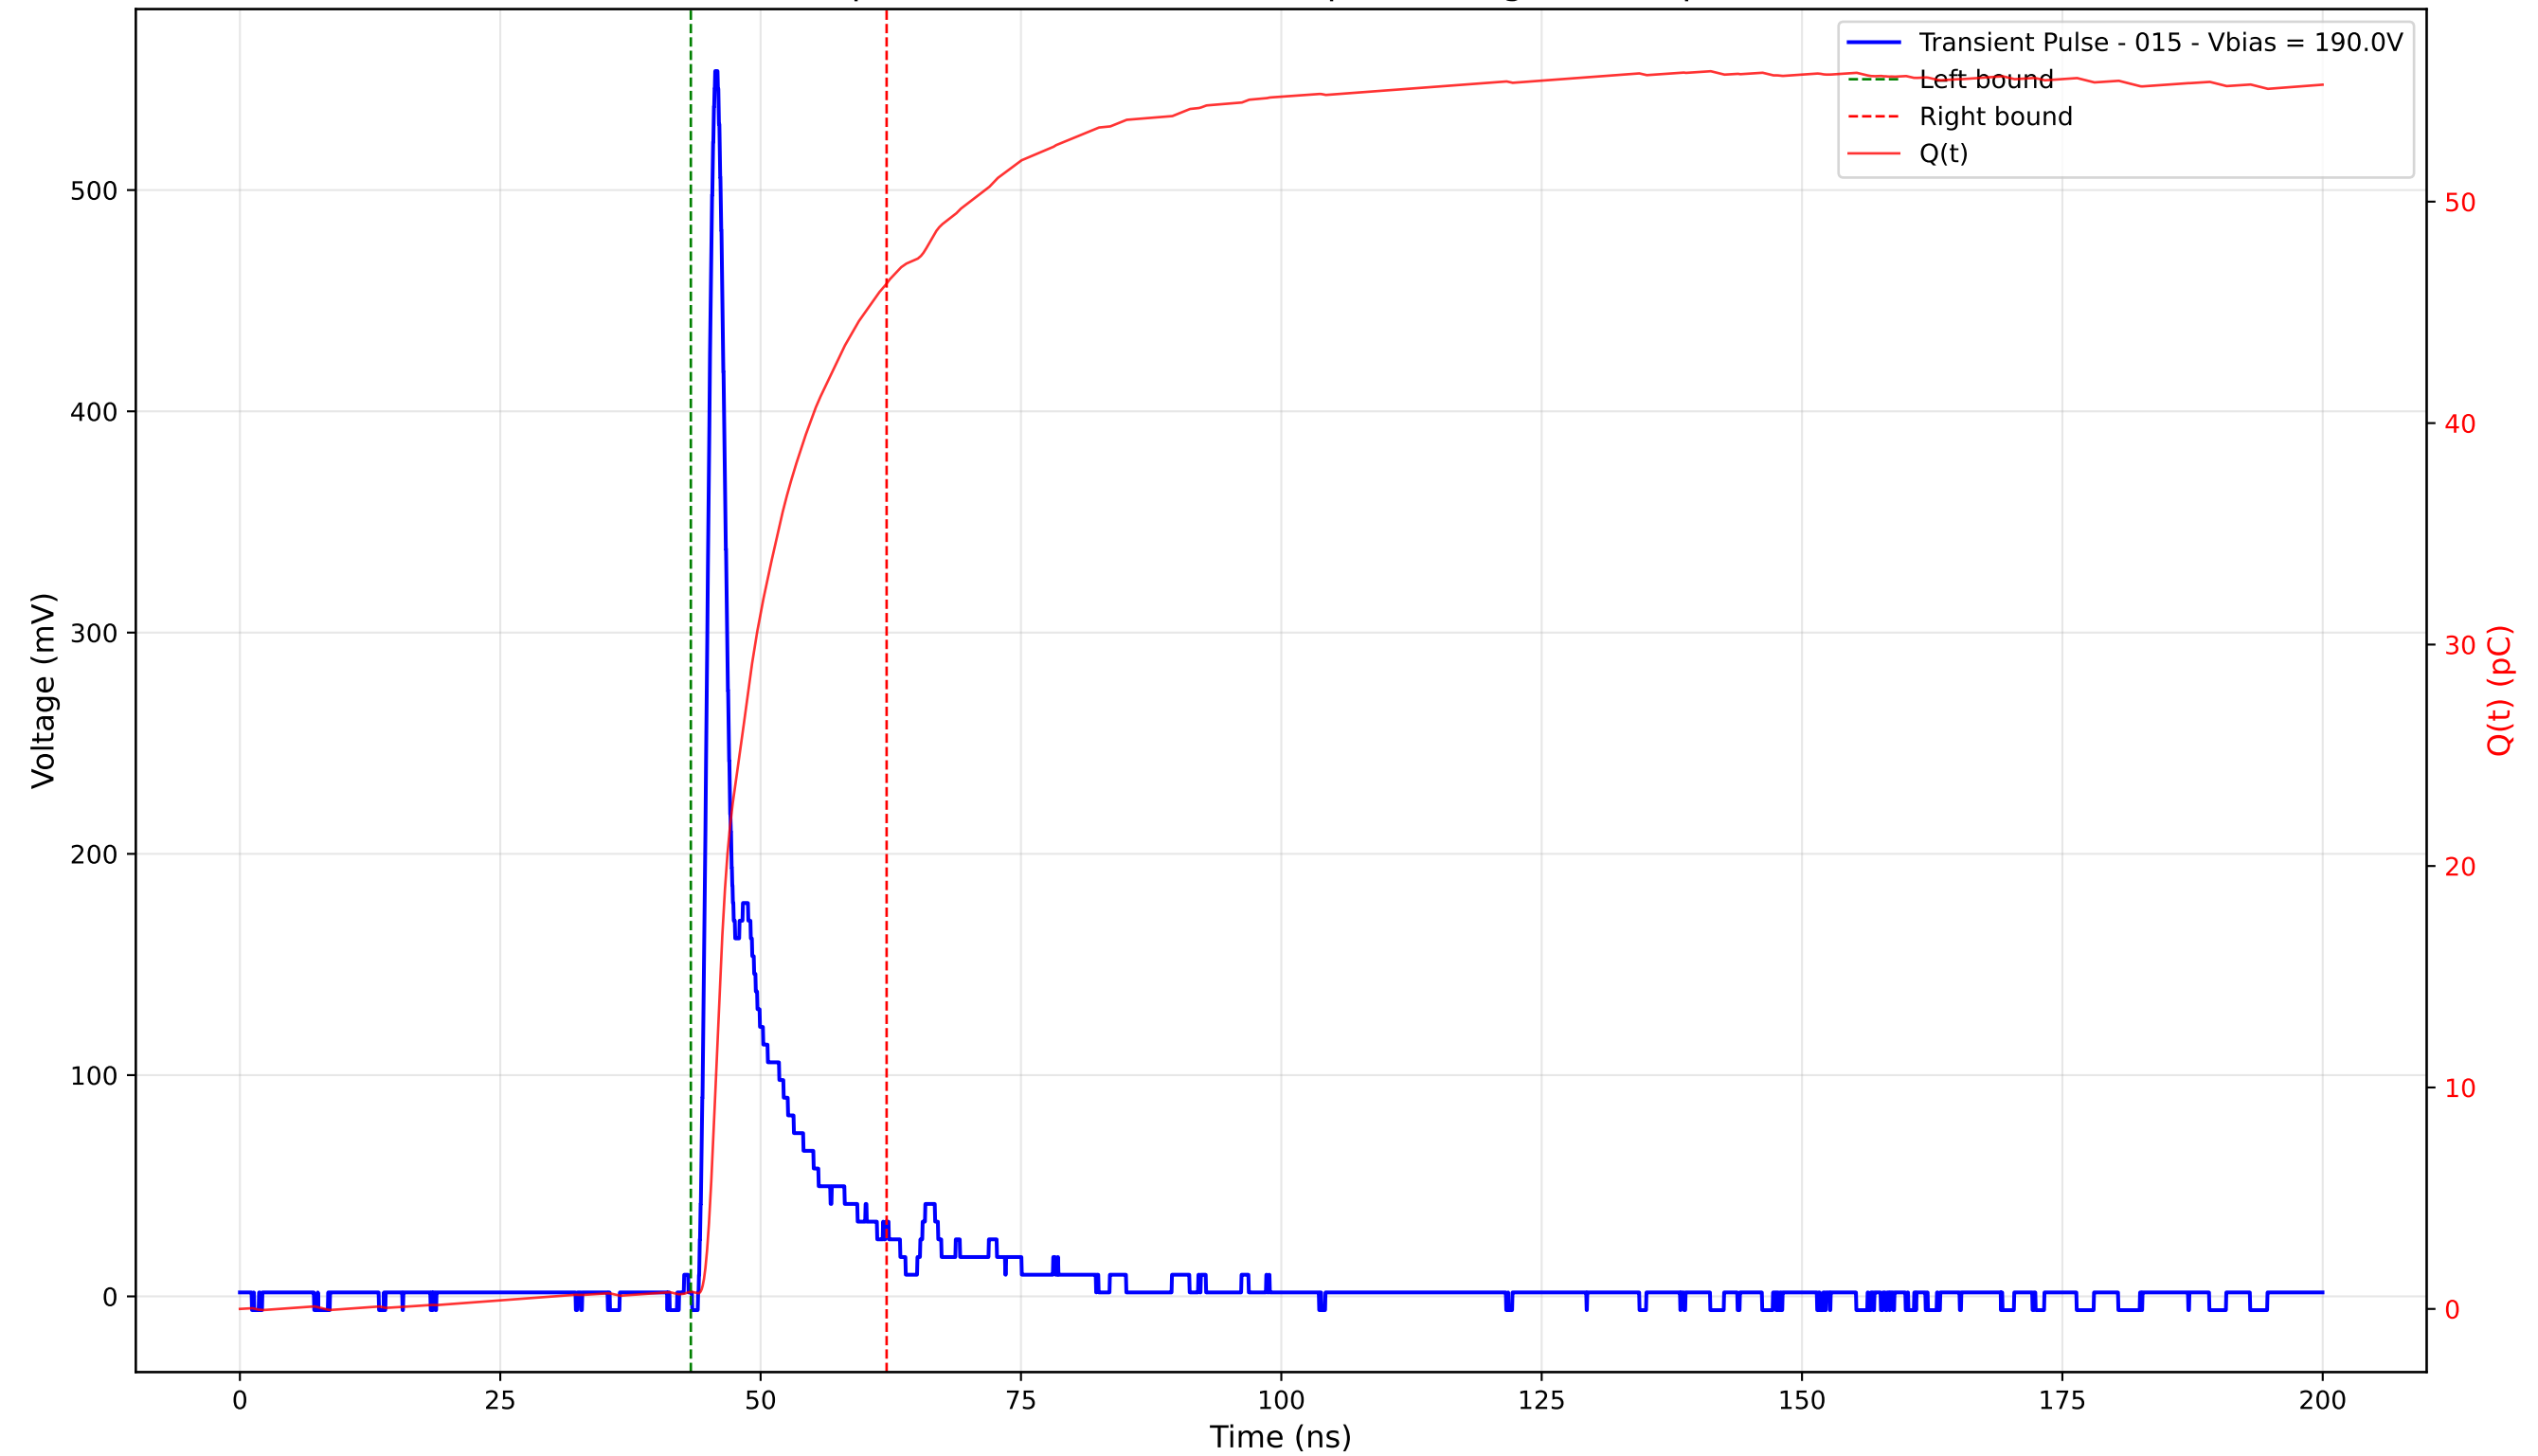


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 44.41 pC - Rise Time: 1.10 ns

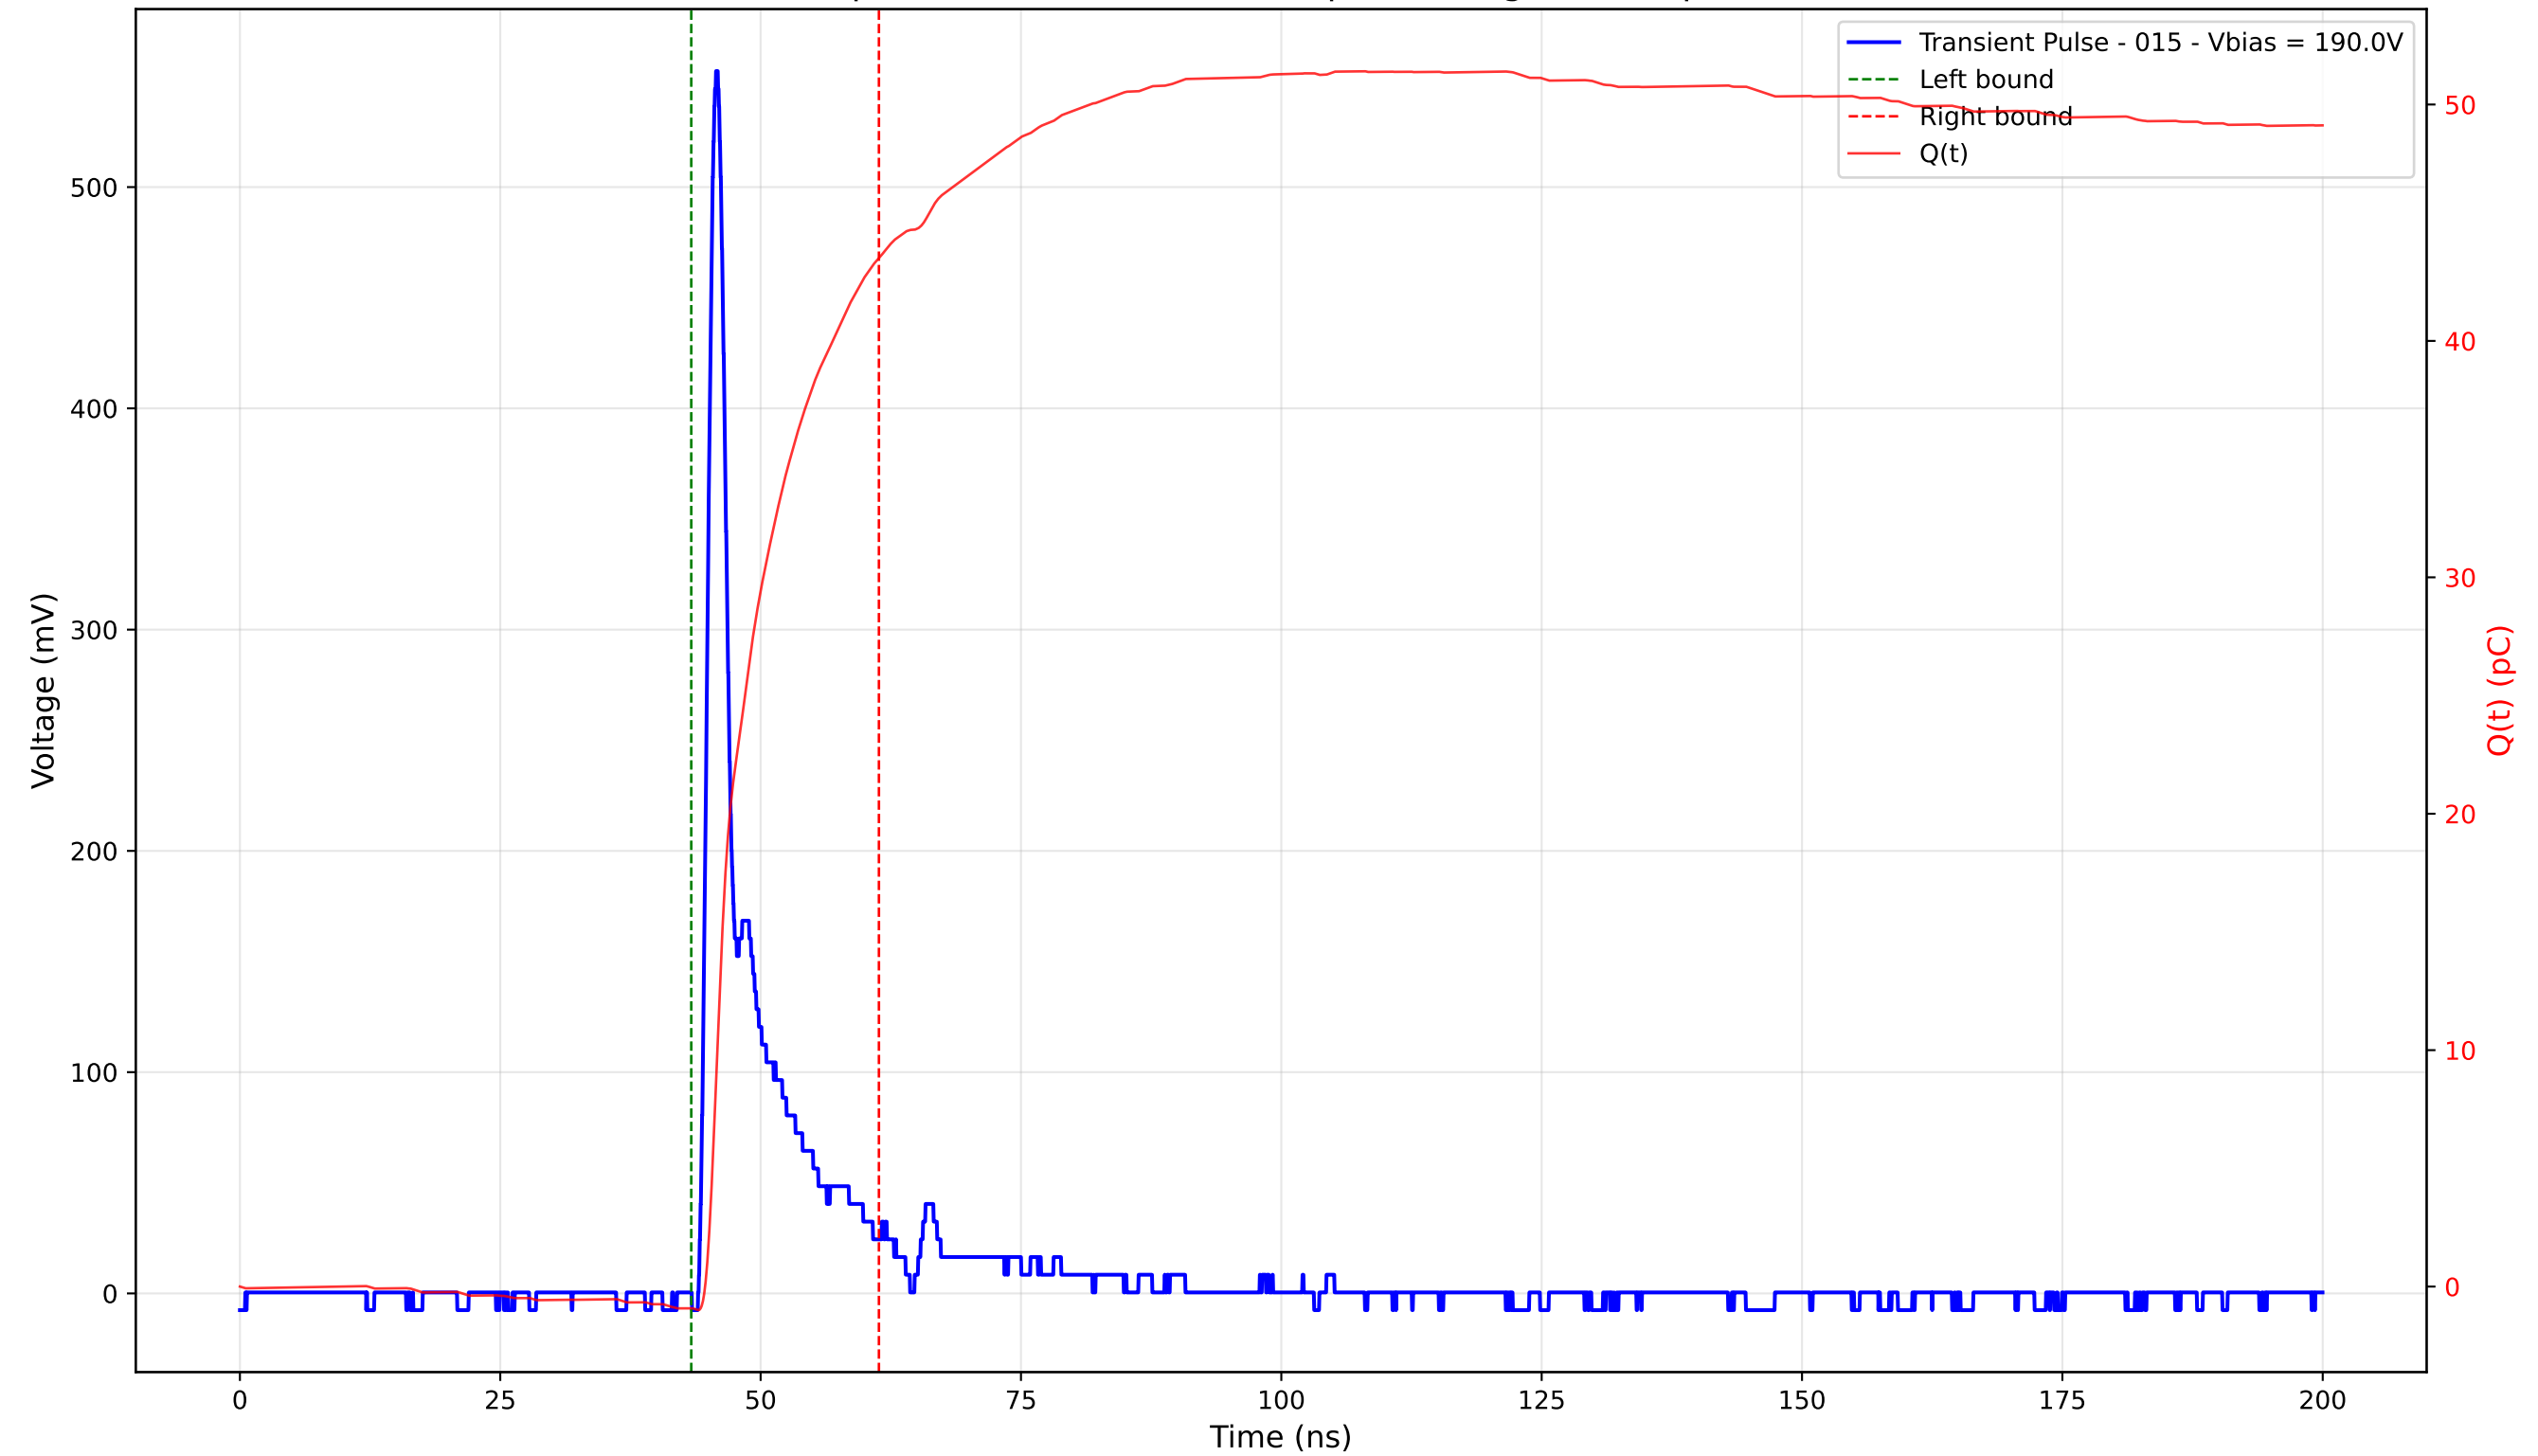


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 45.24 pC - Rise Time: 1.11 ns

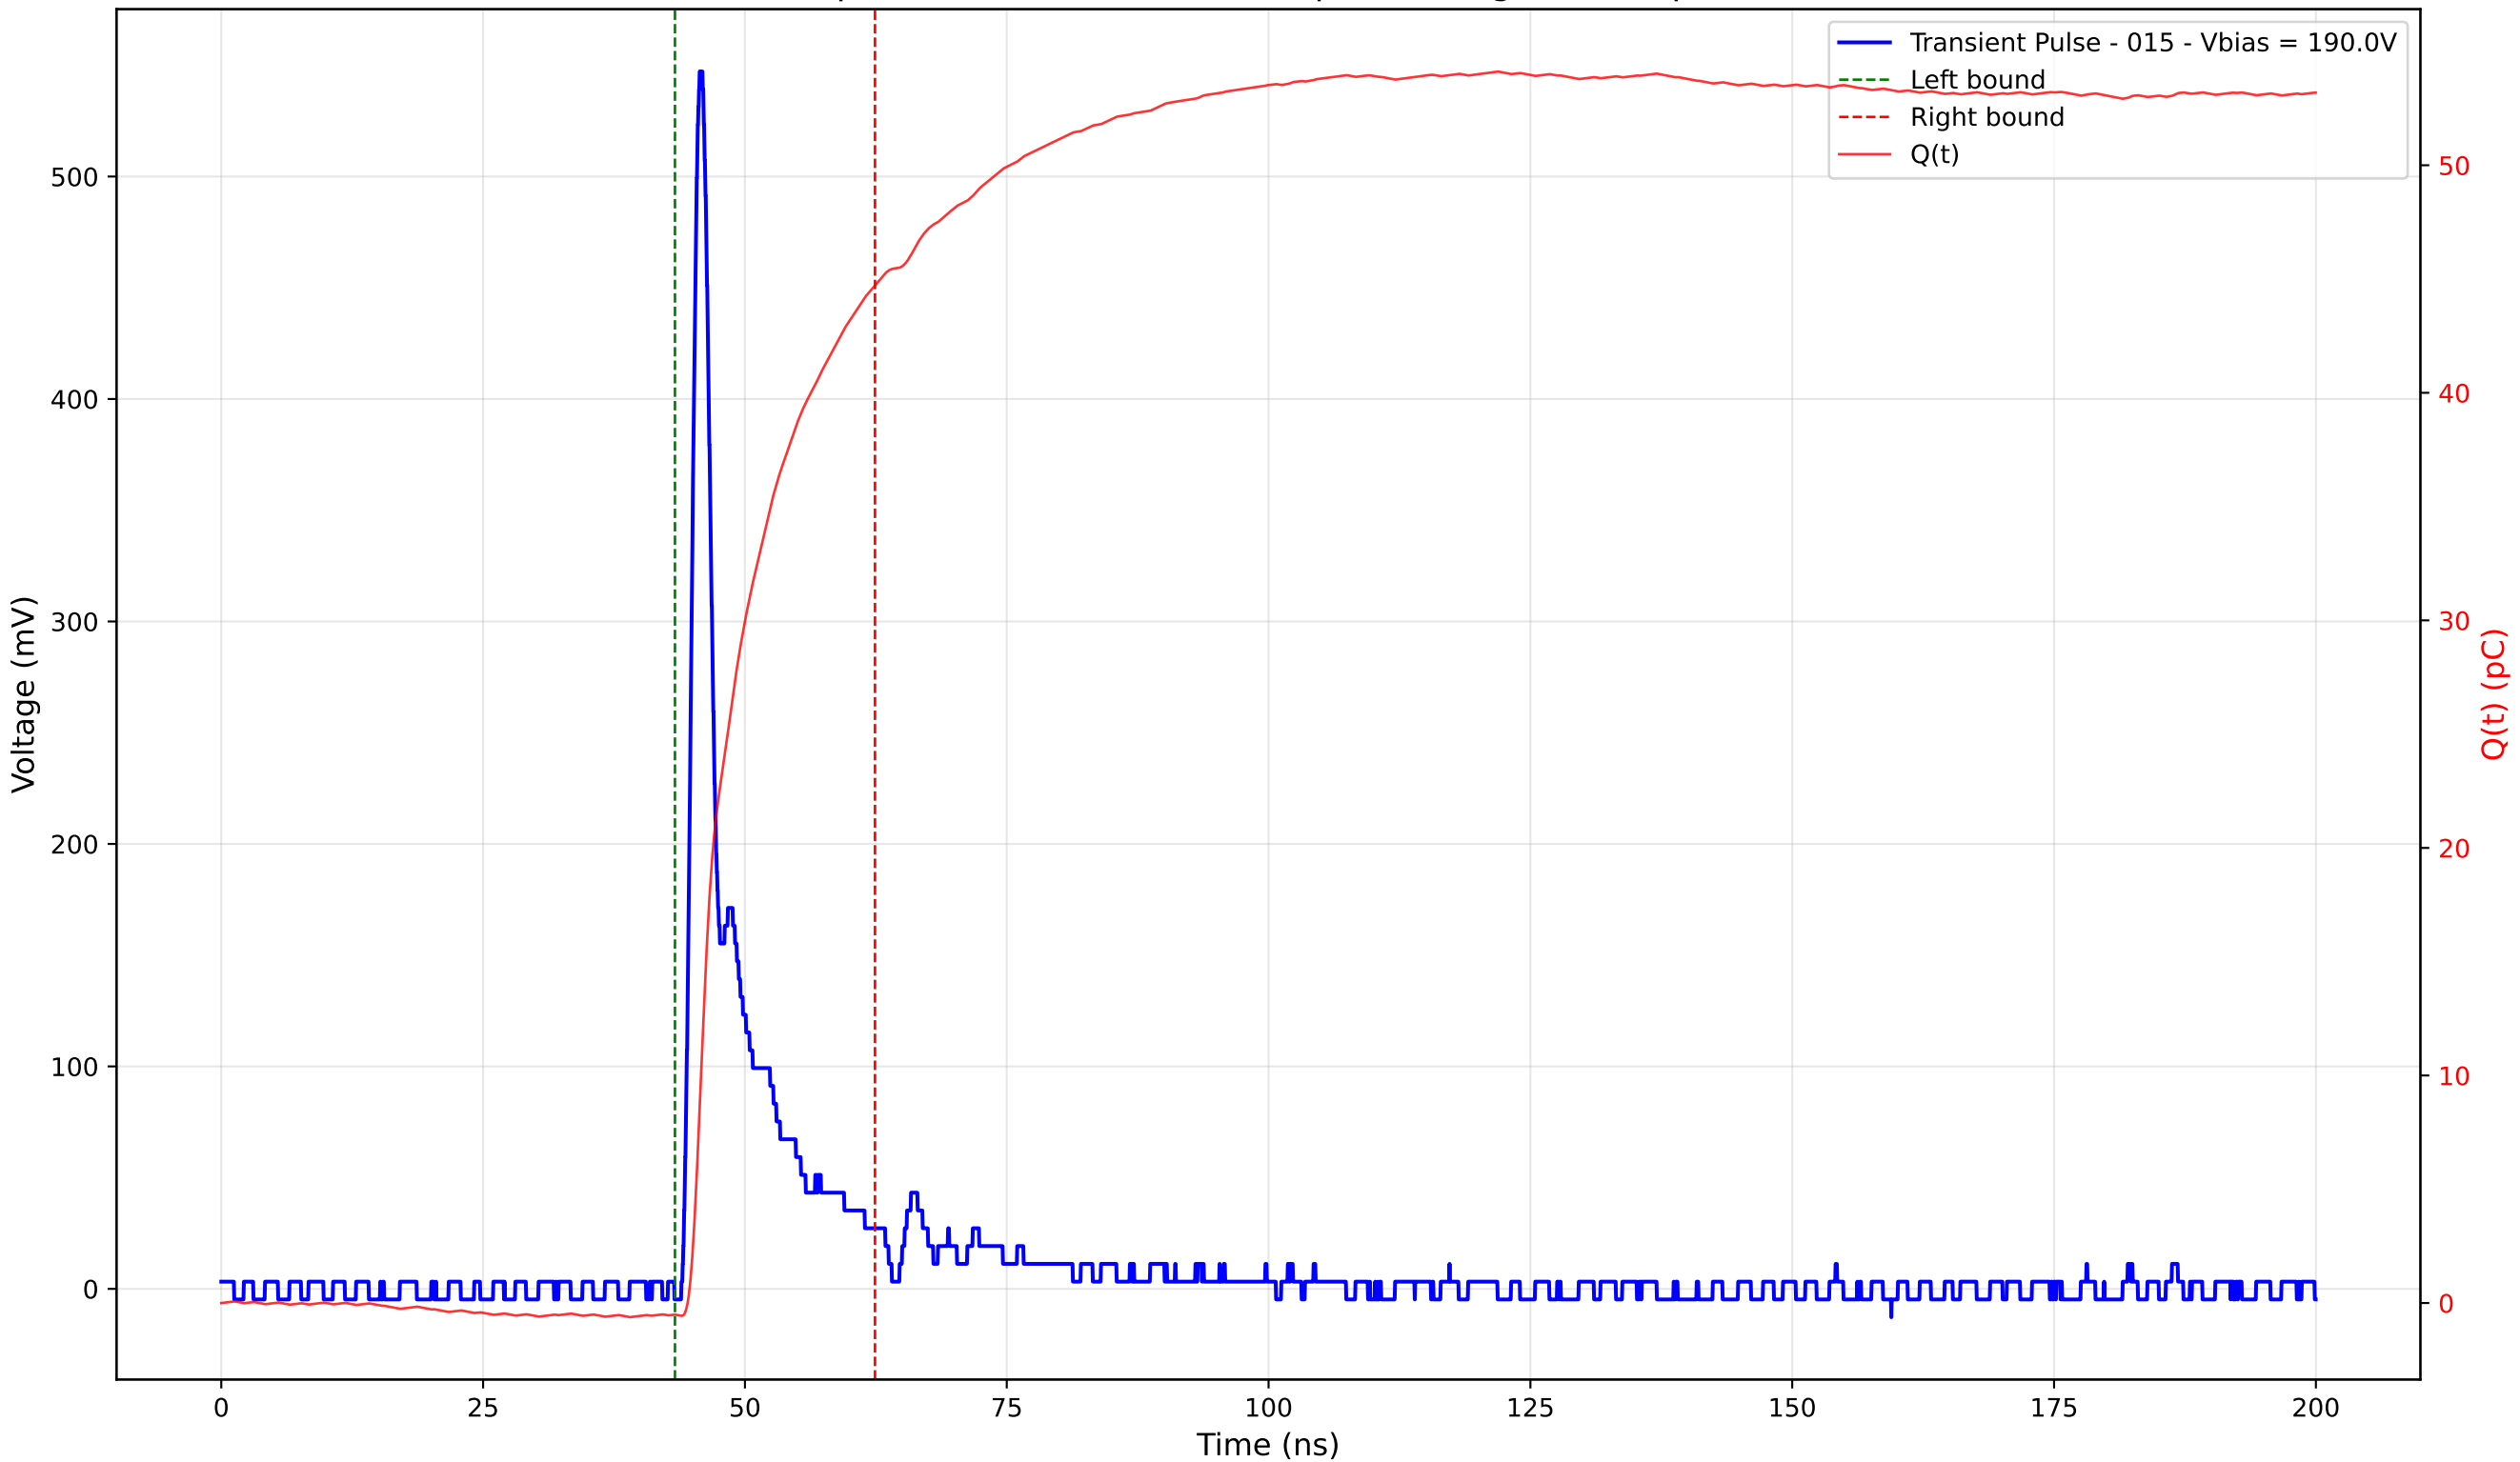


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 44.98 pC - Rise Time: 1.10 ns

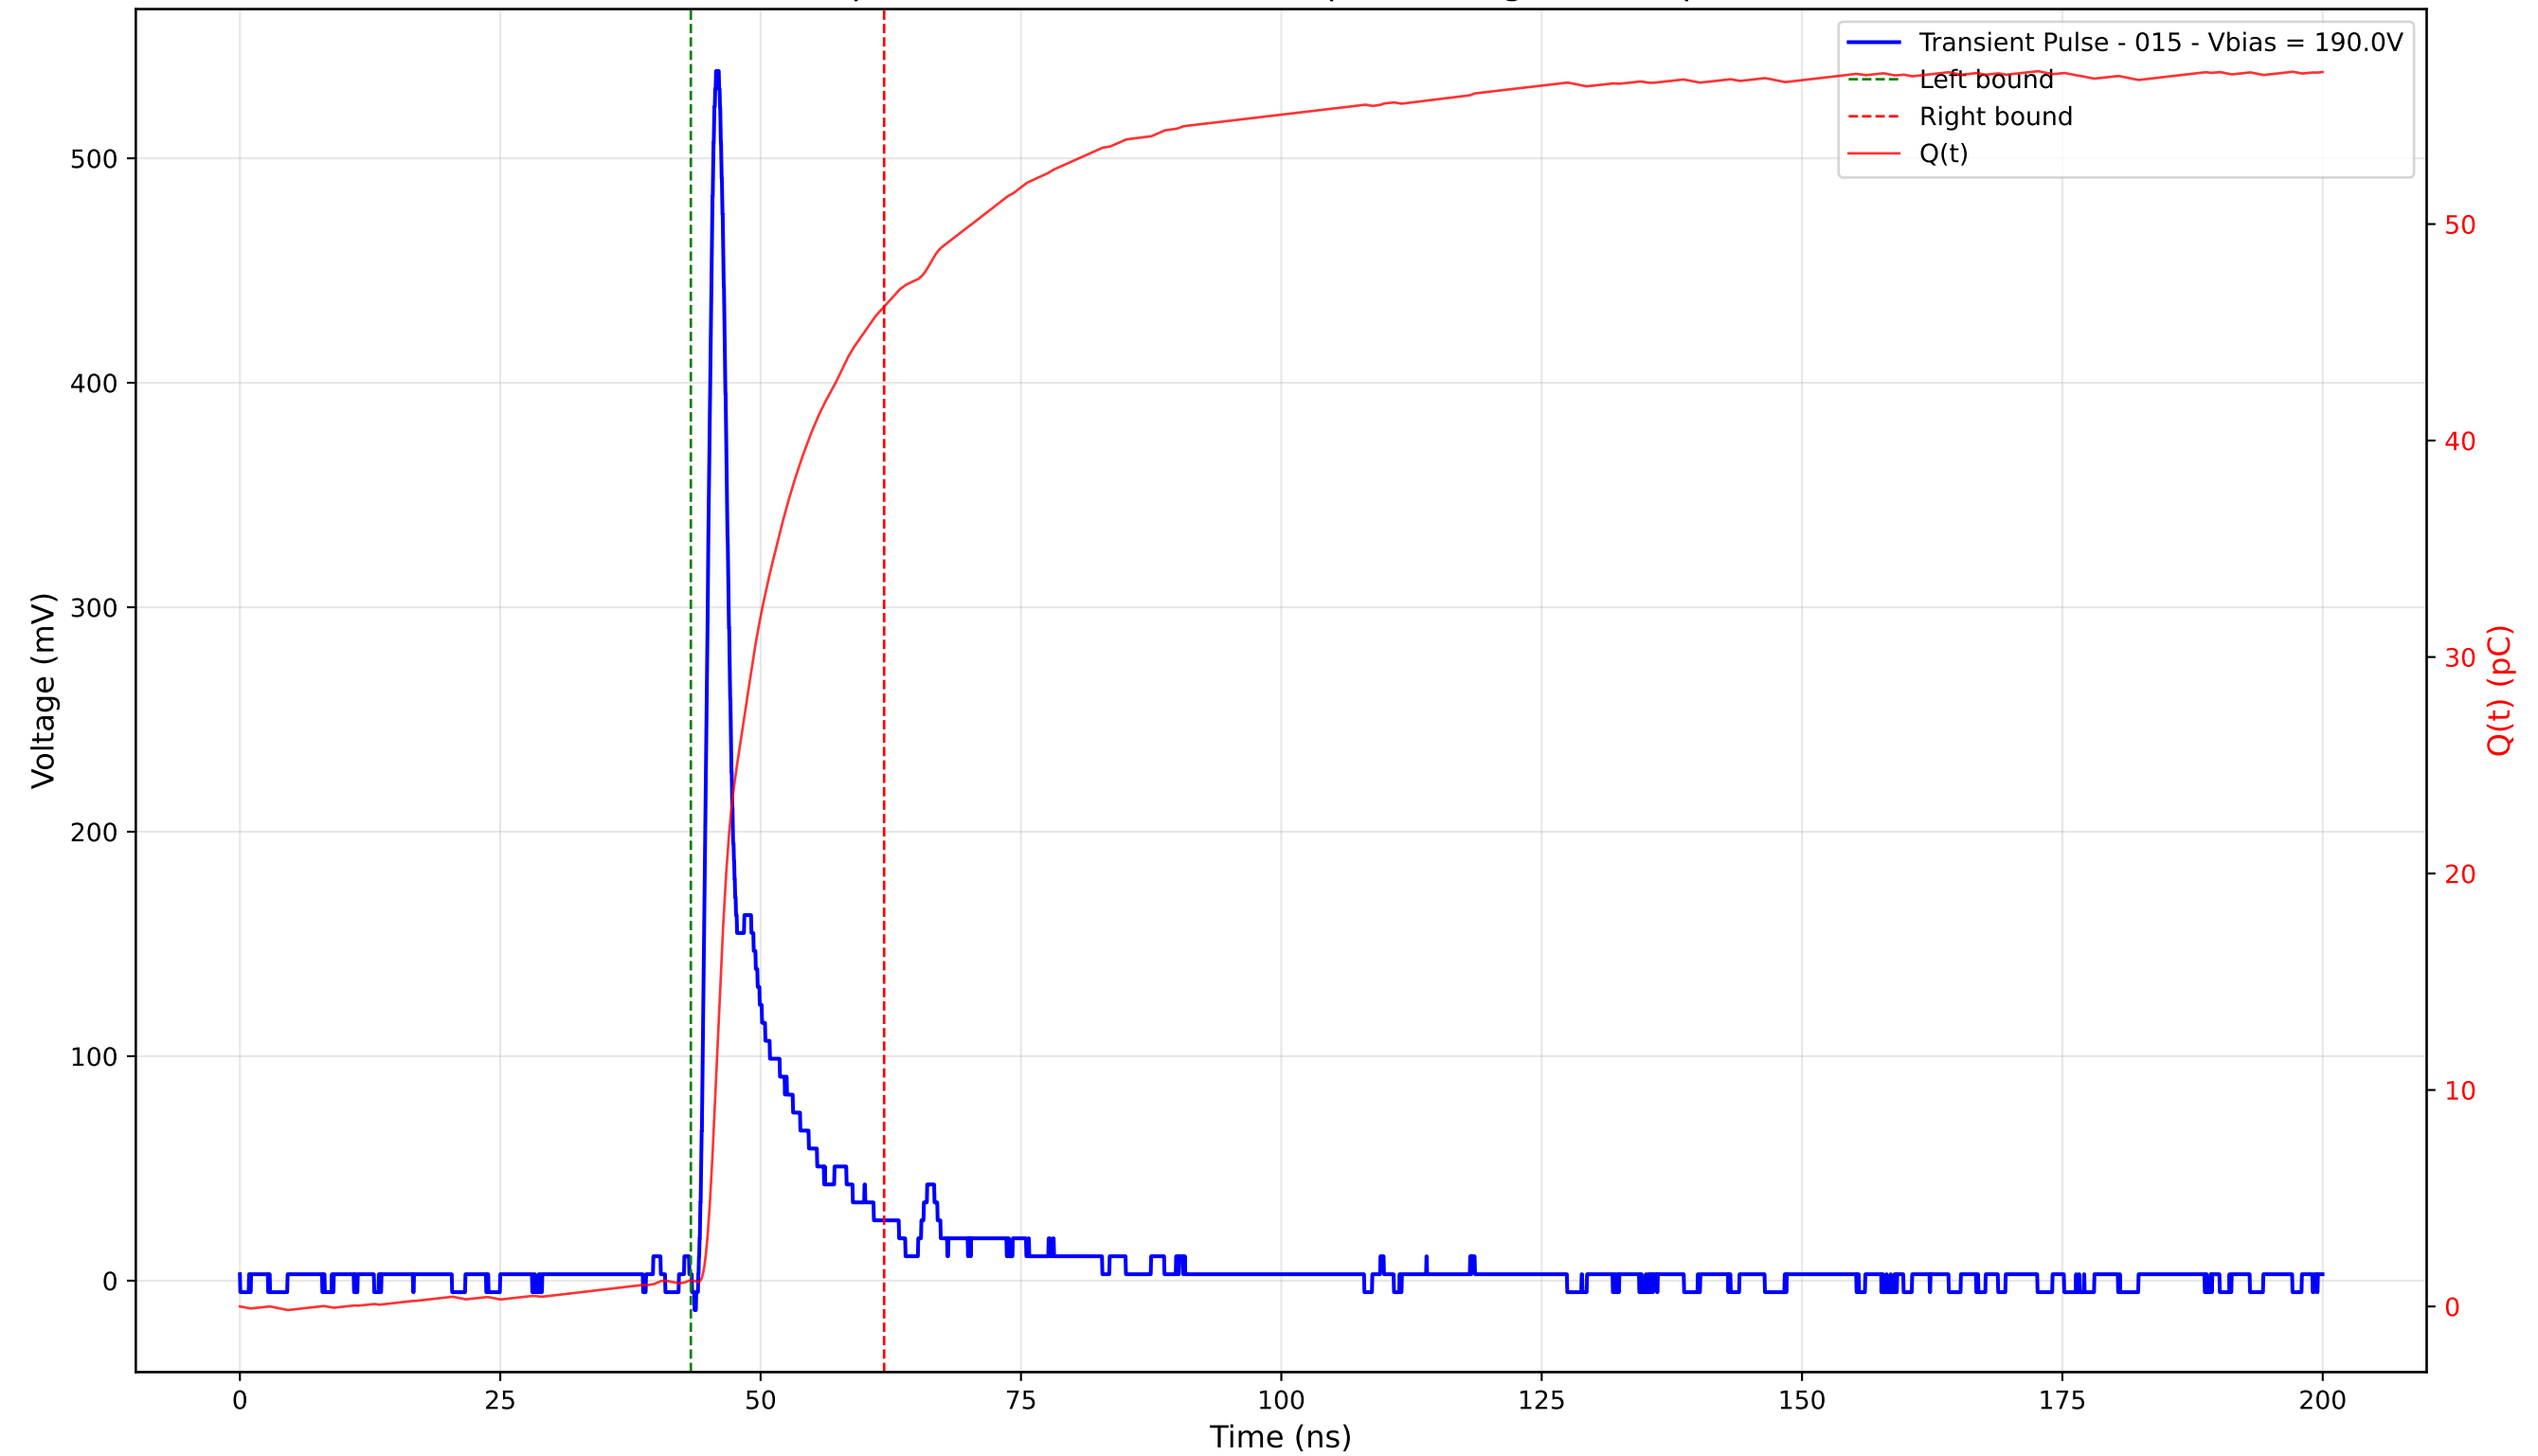


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 44.16 pC - Rise Time: 1.09 ns

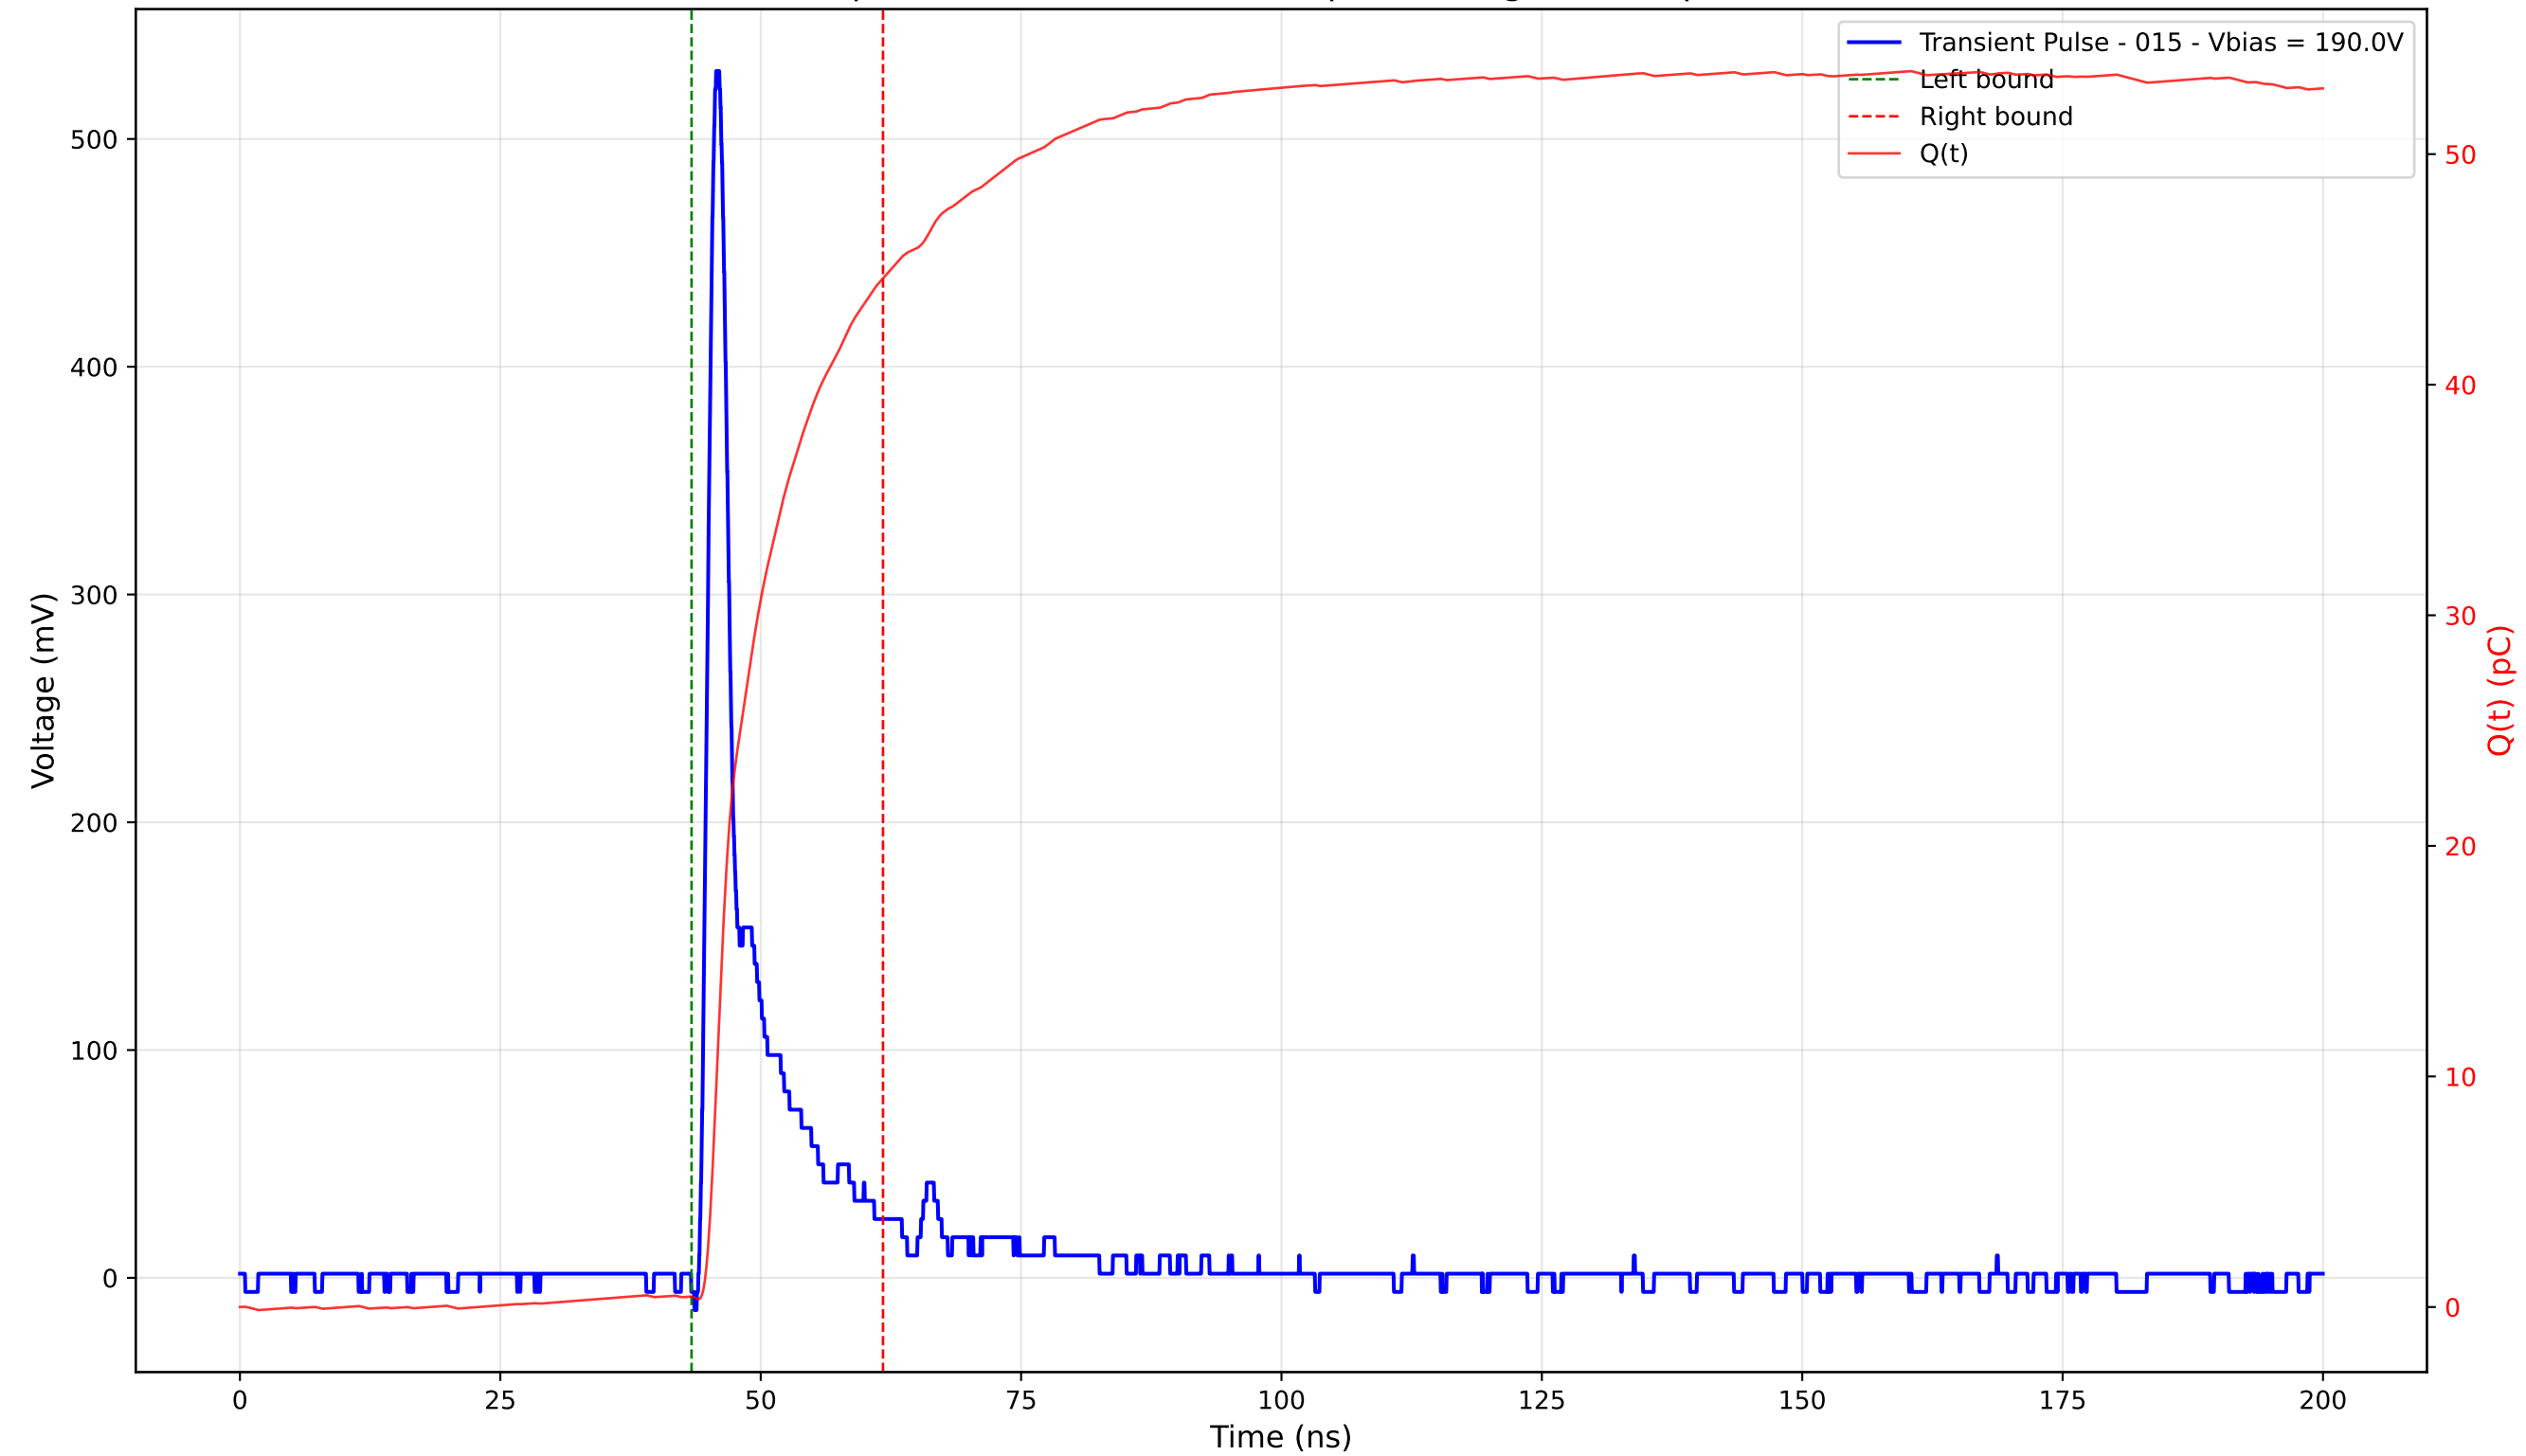


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 43.74 pC - Rise Time: 1.15 ns

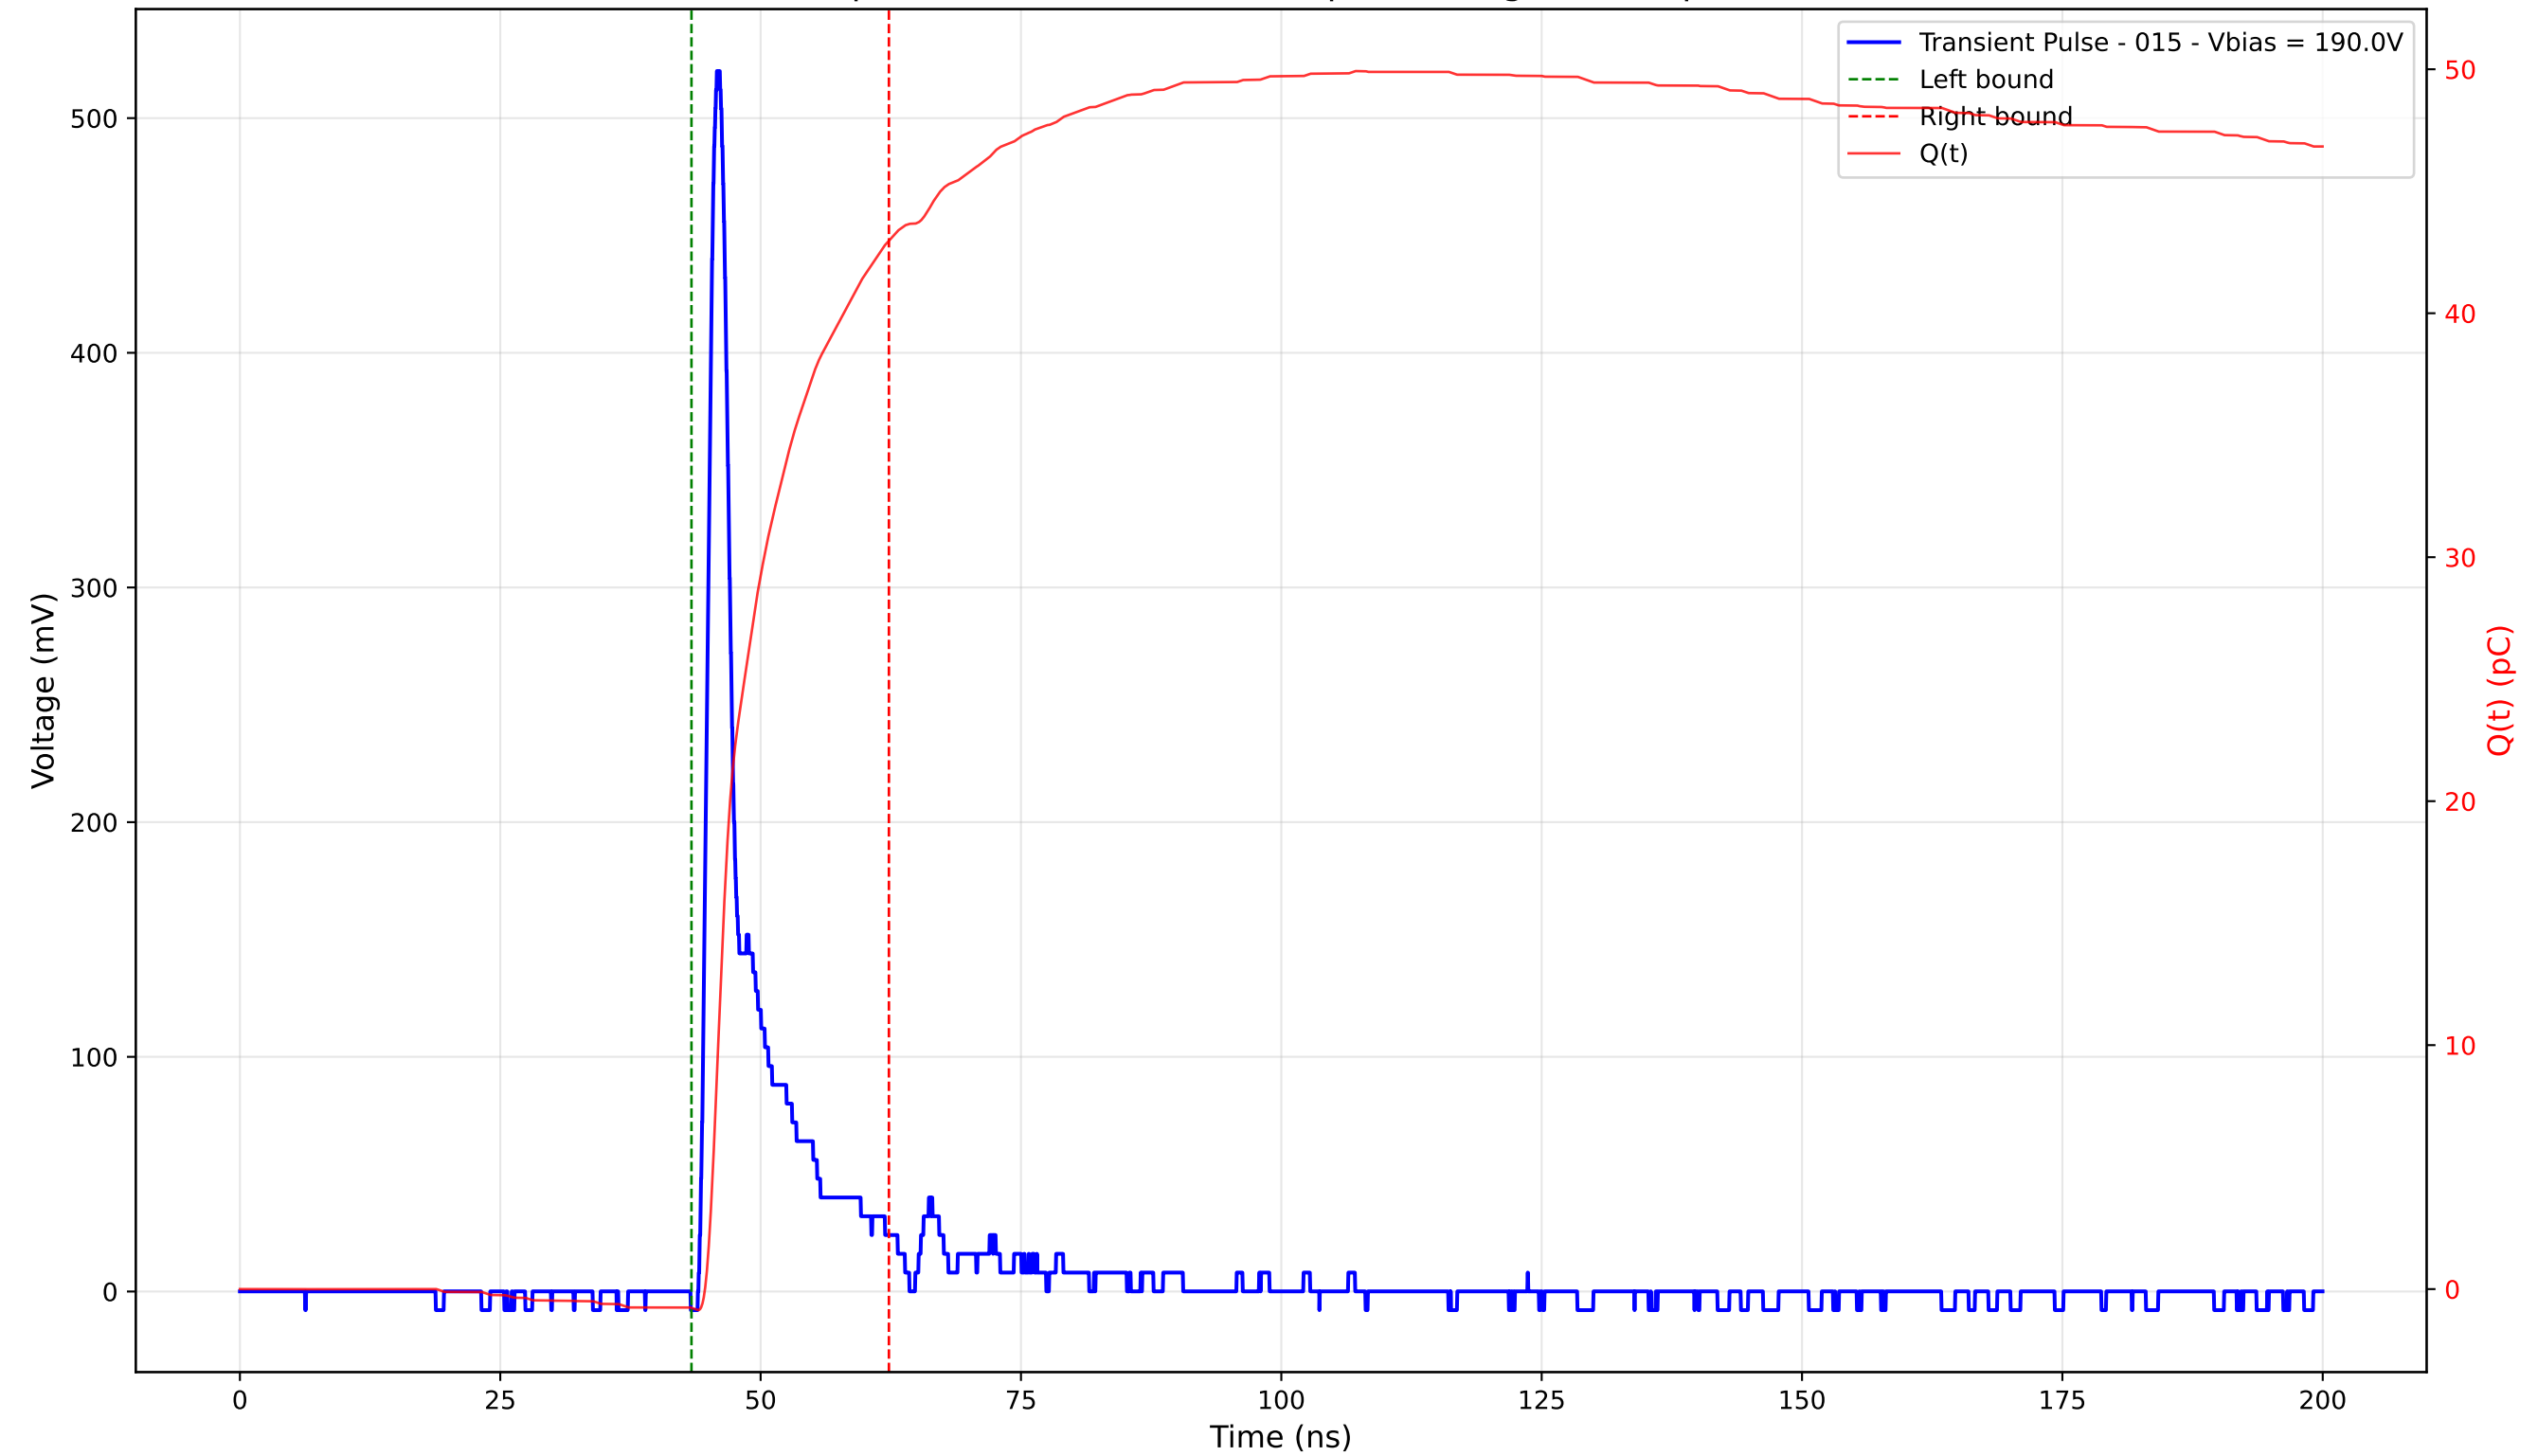


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 42.99 pC - Rise Time: 1.14 ns

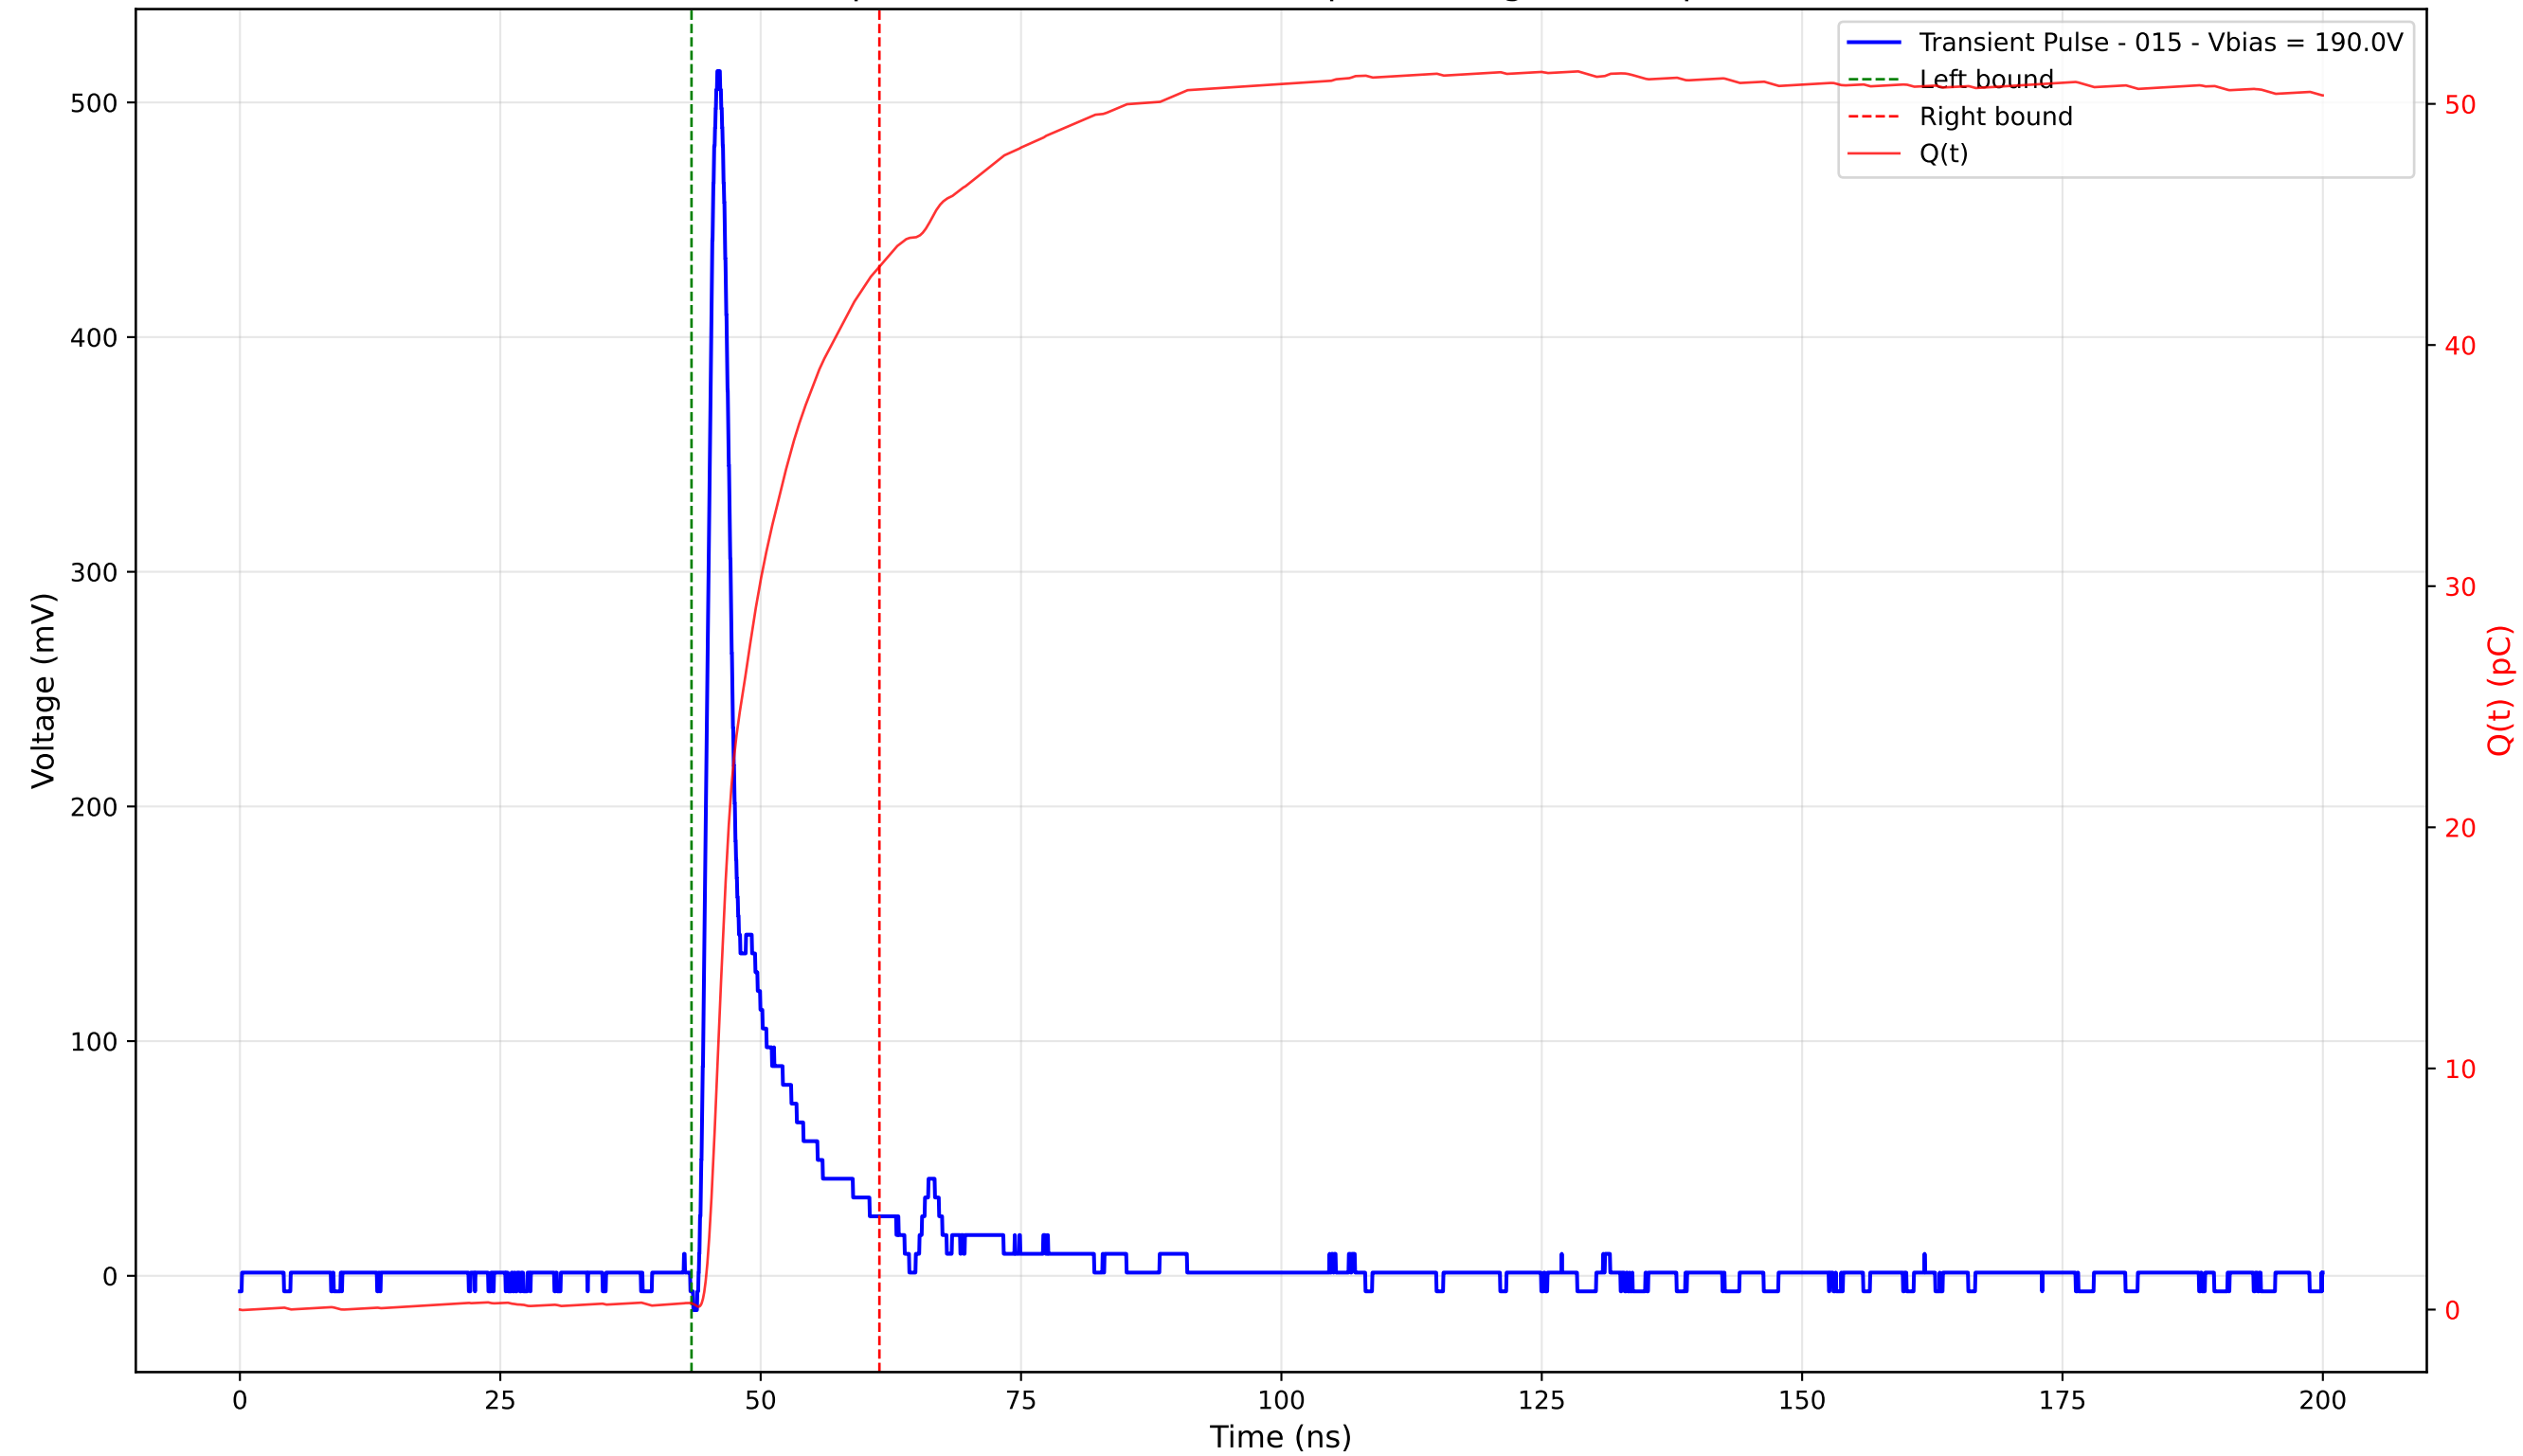


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 43.53 pC - Rise Time: 1.16 ns

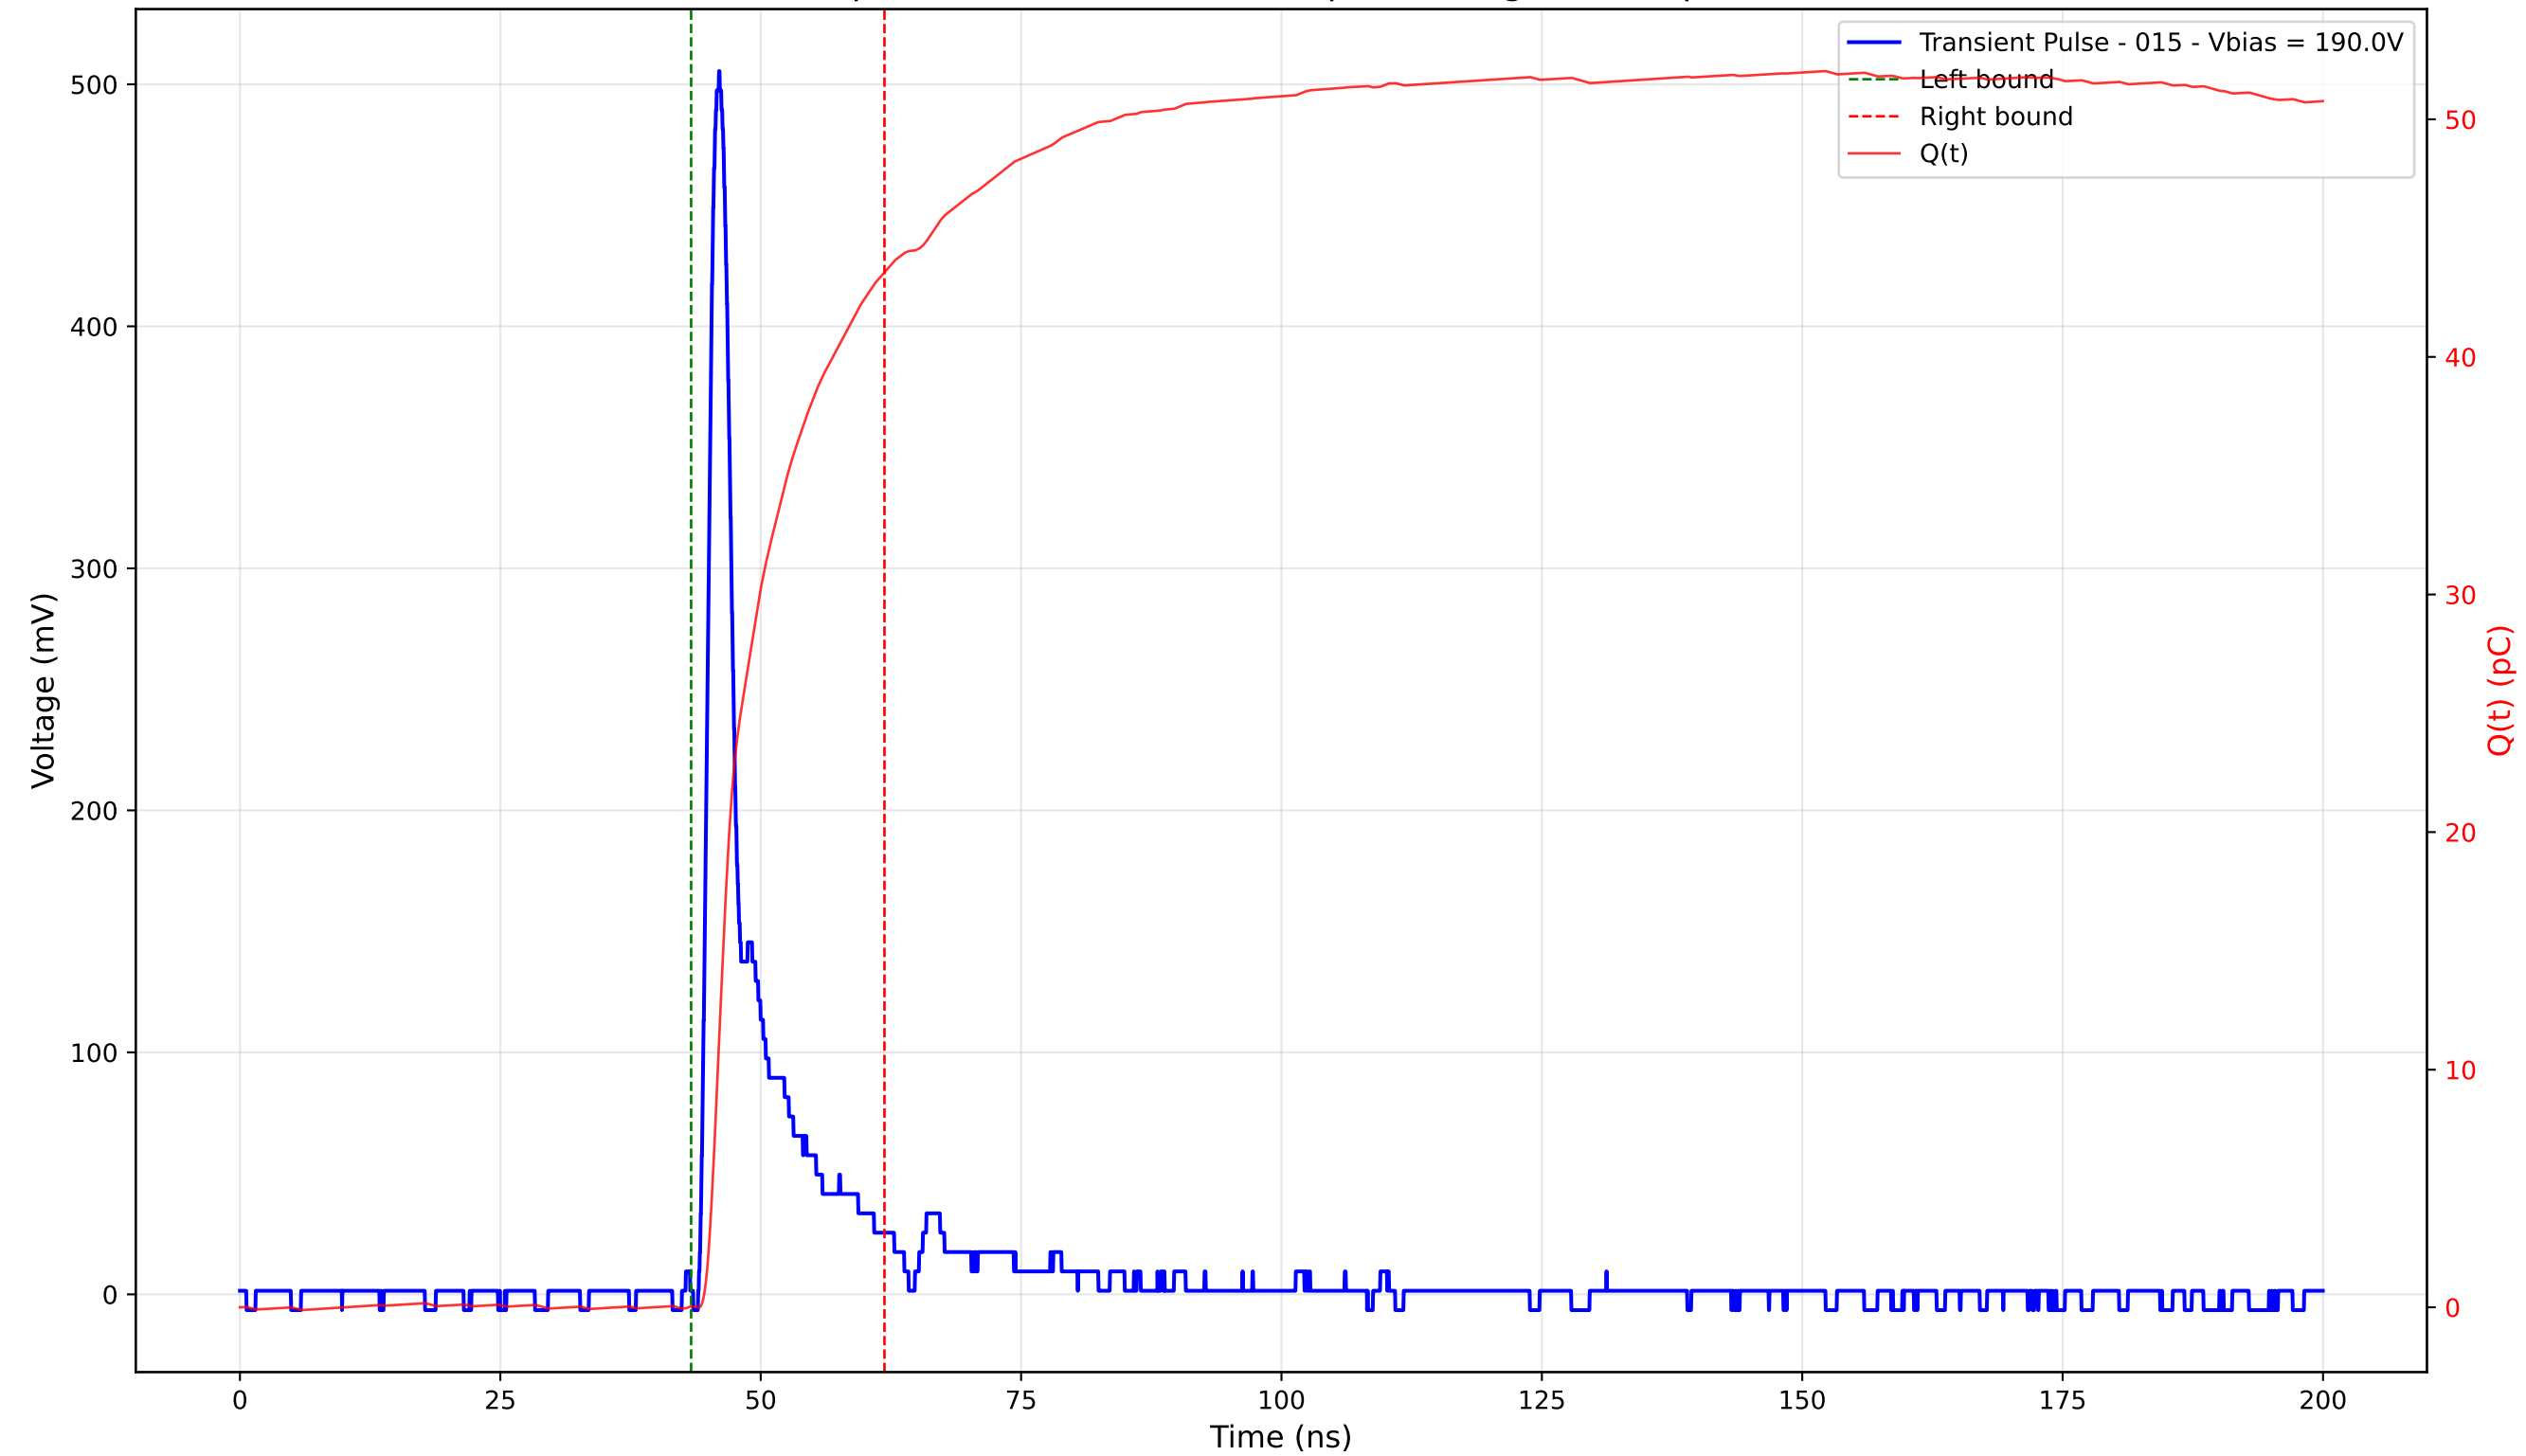


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 43.46 pC - Rise Time: 1.16 ns

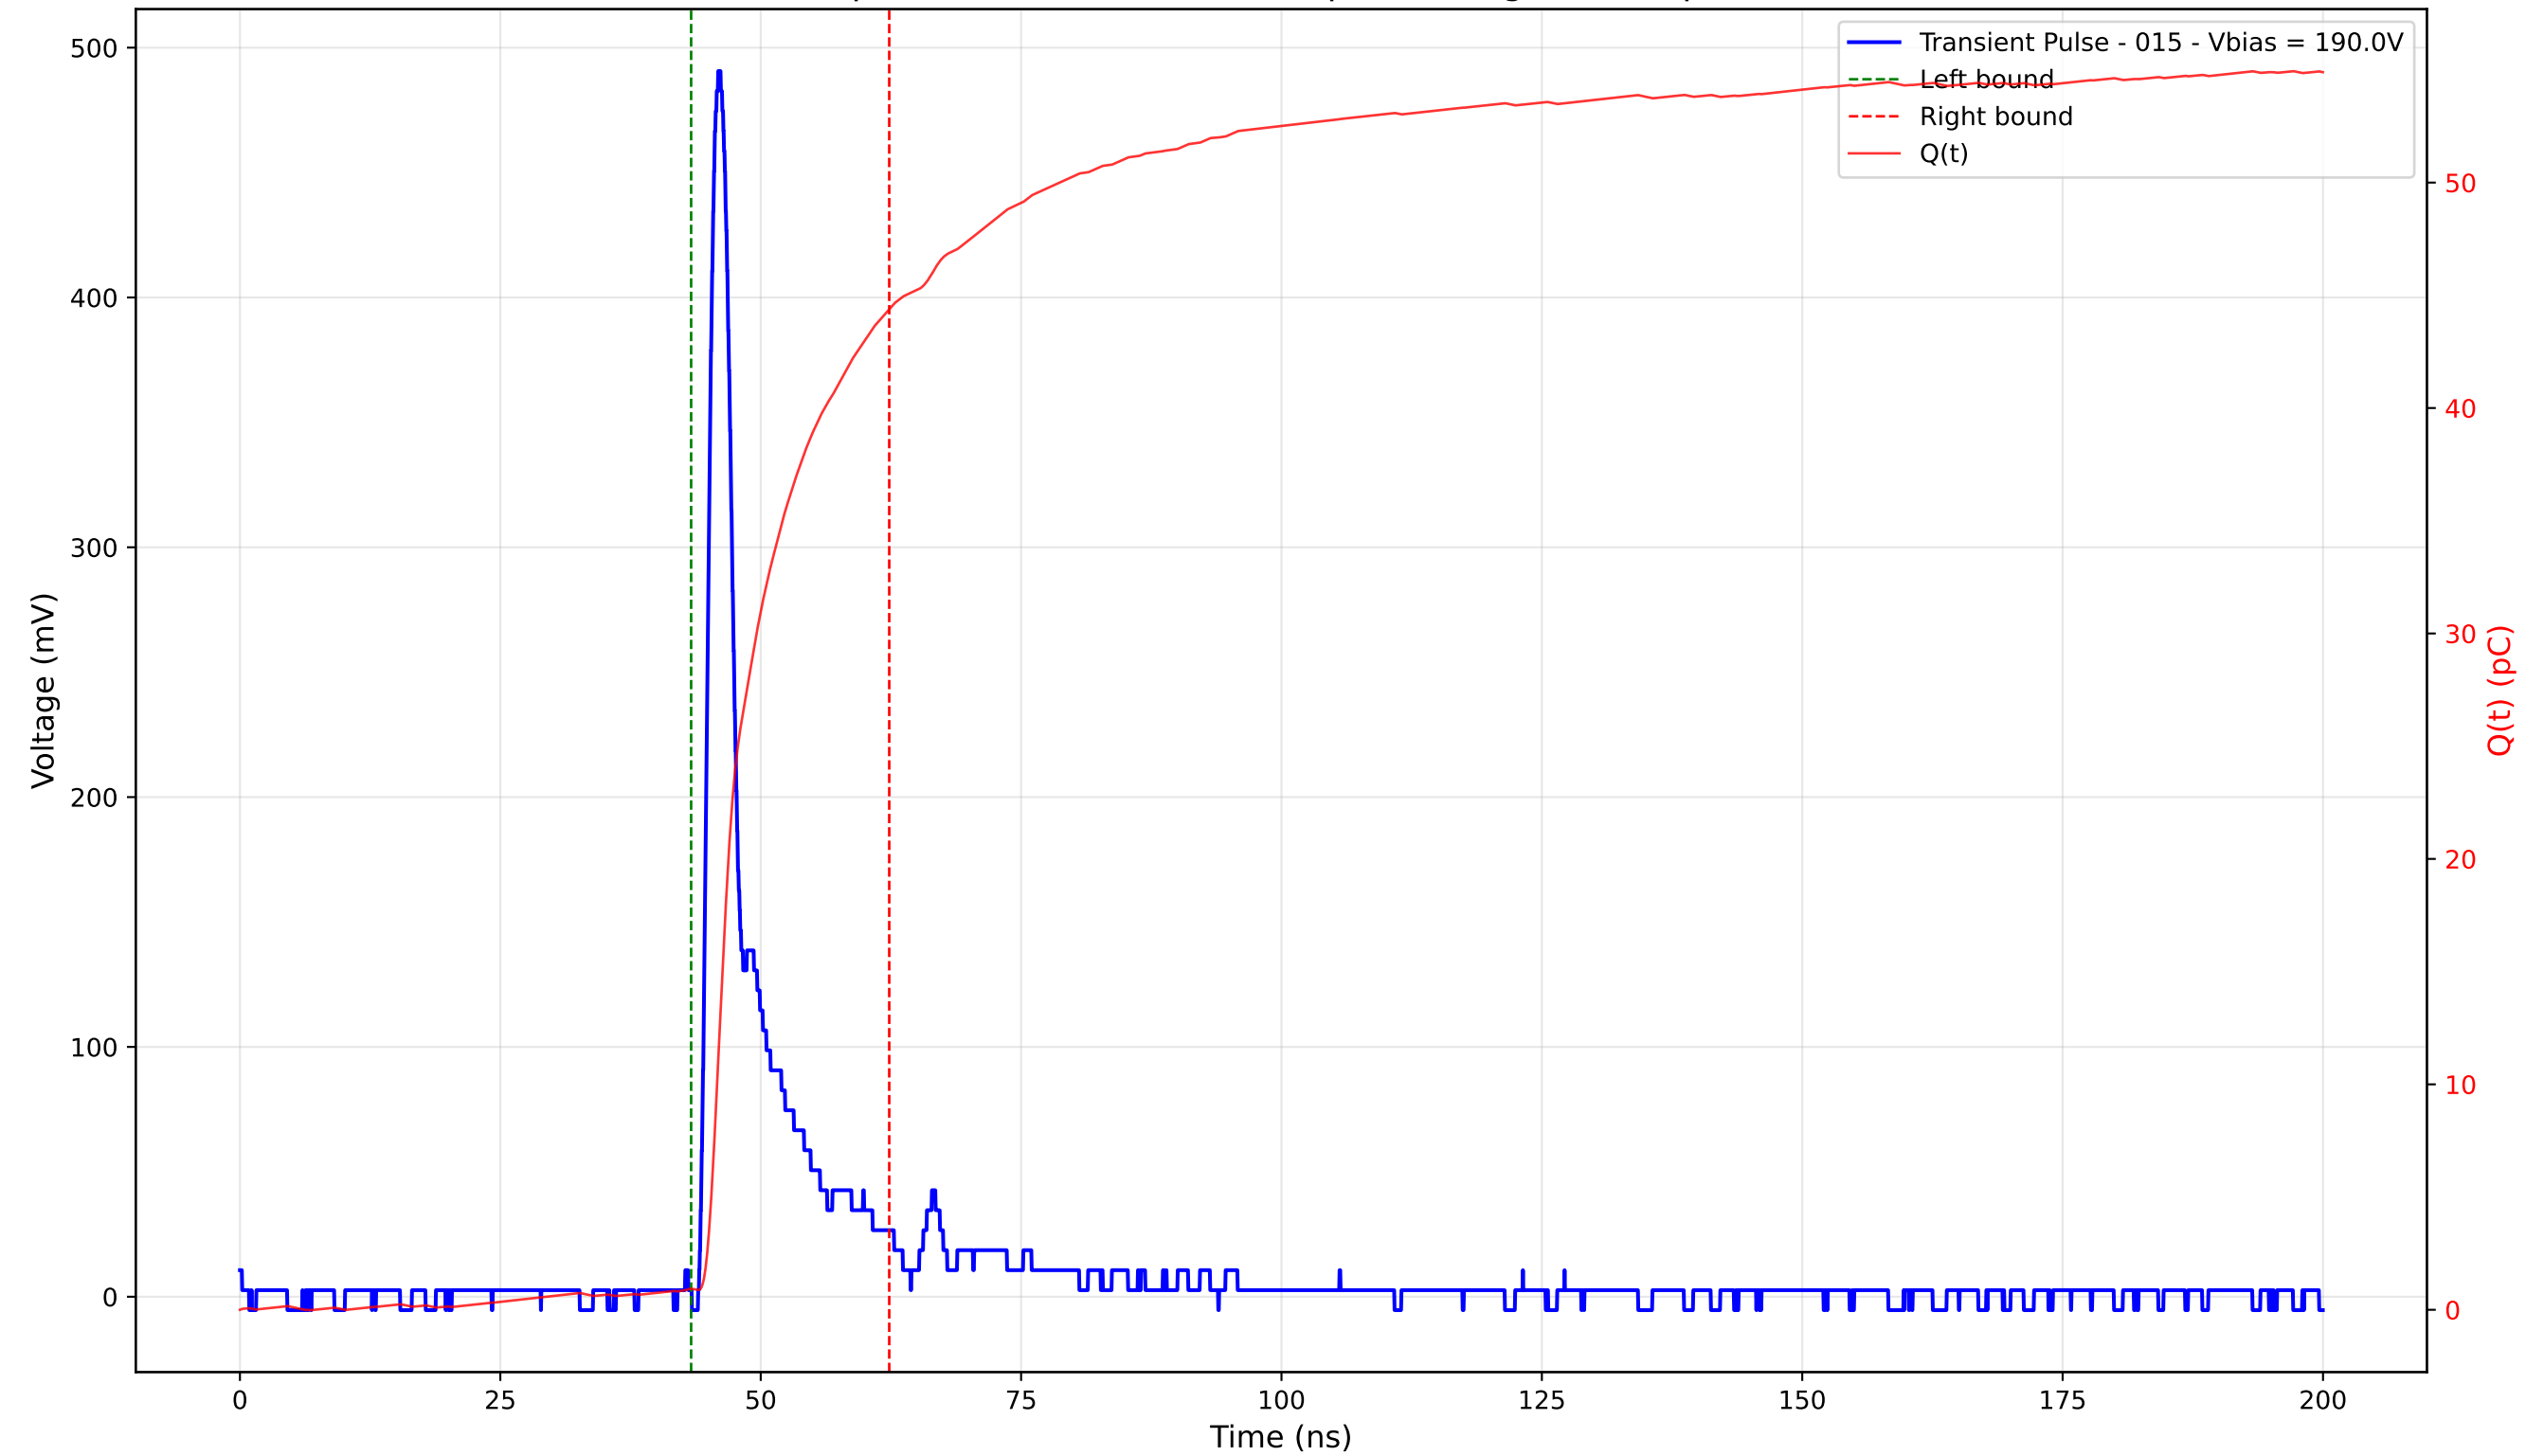


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 43.01 pC - Rise Time: 1.21 ns

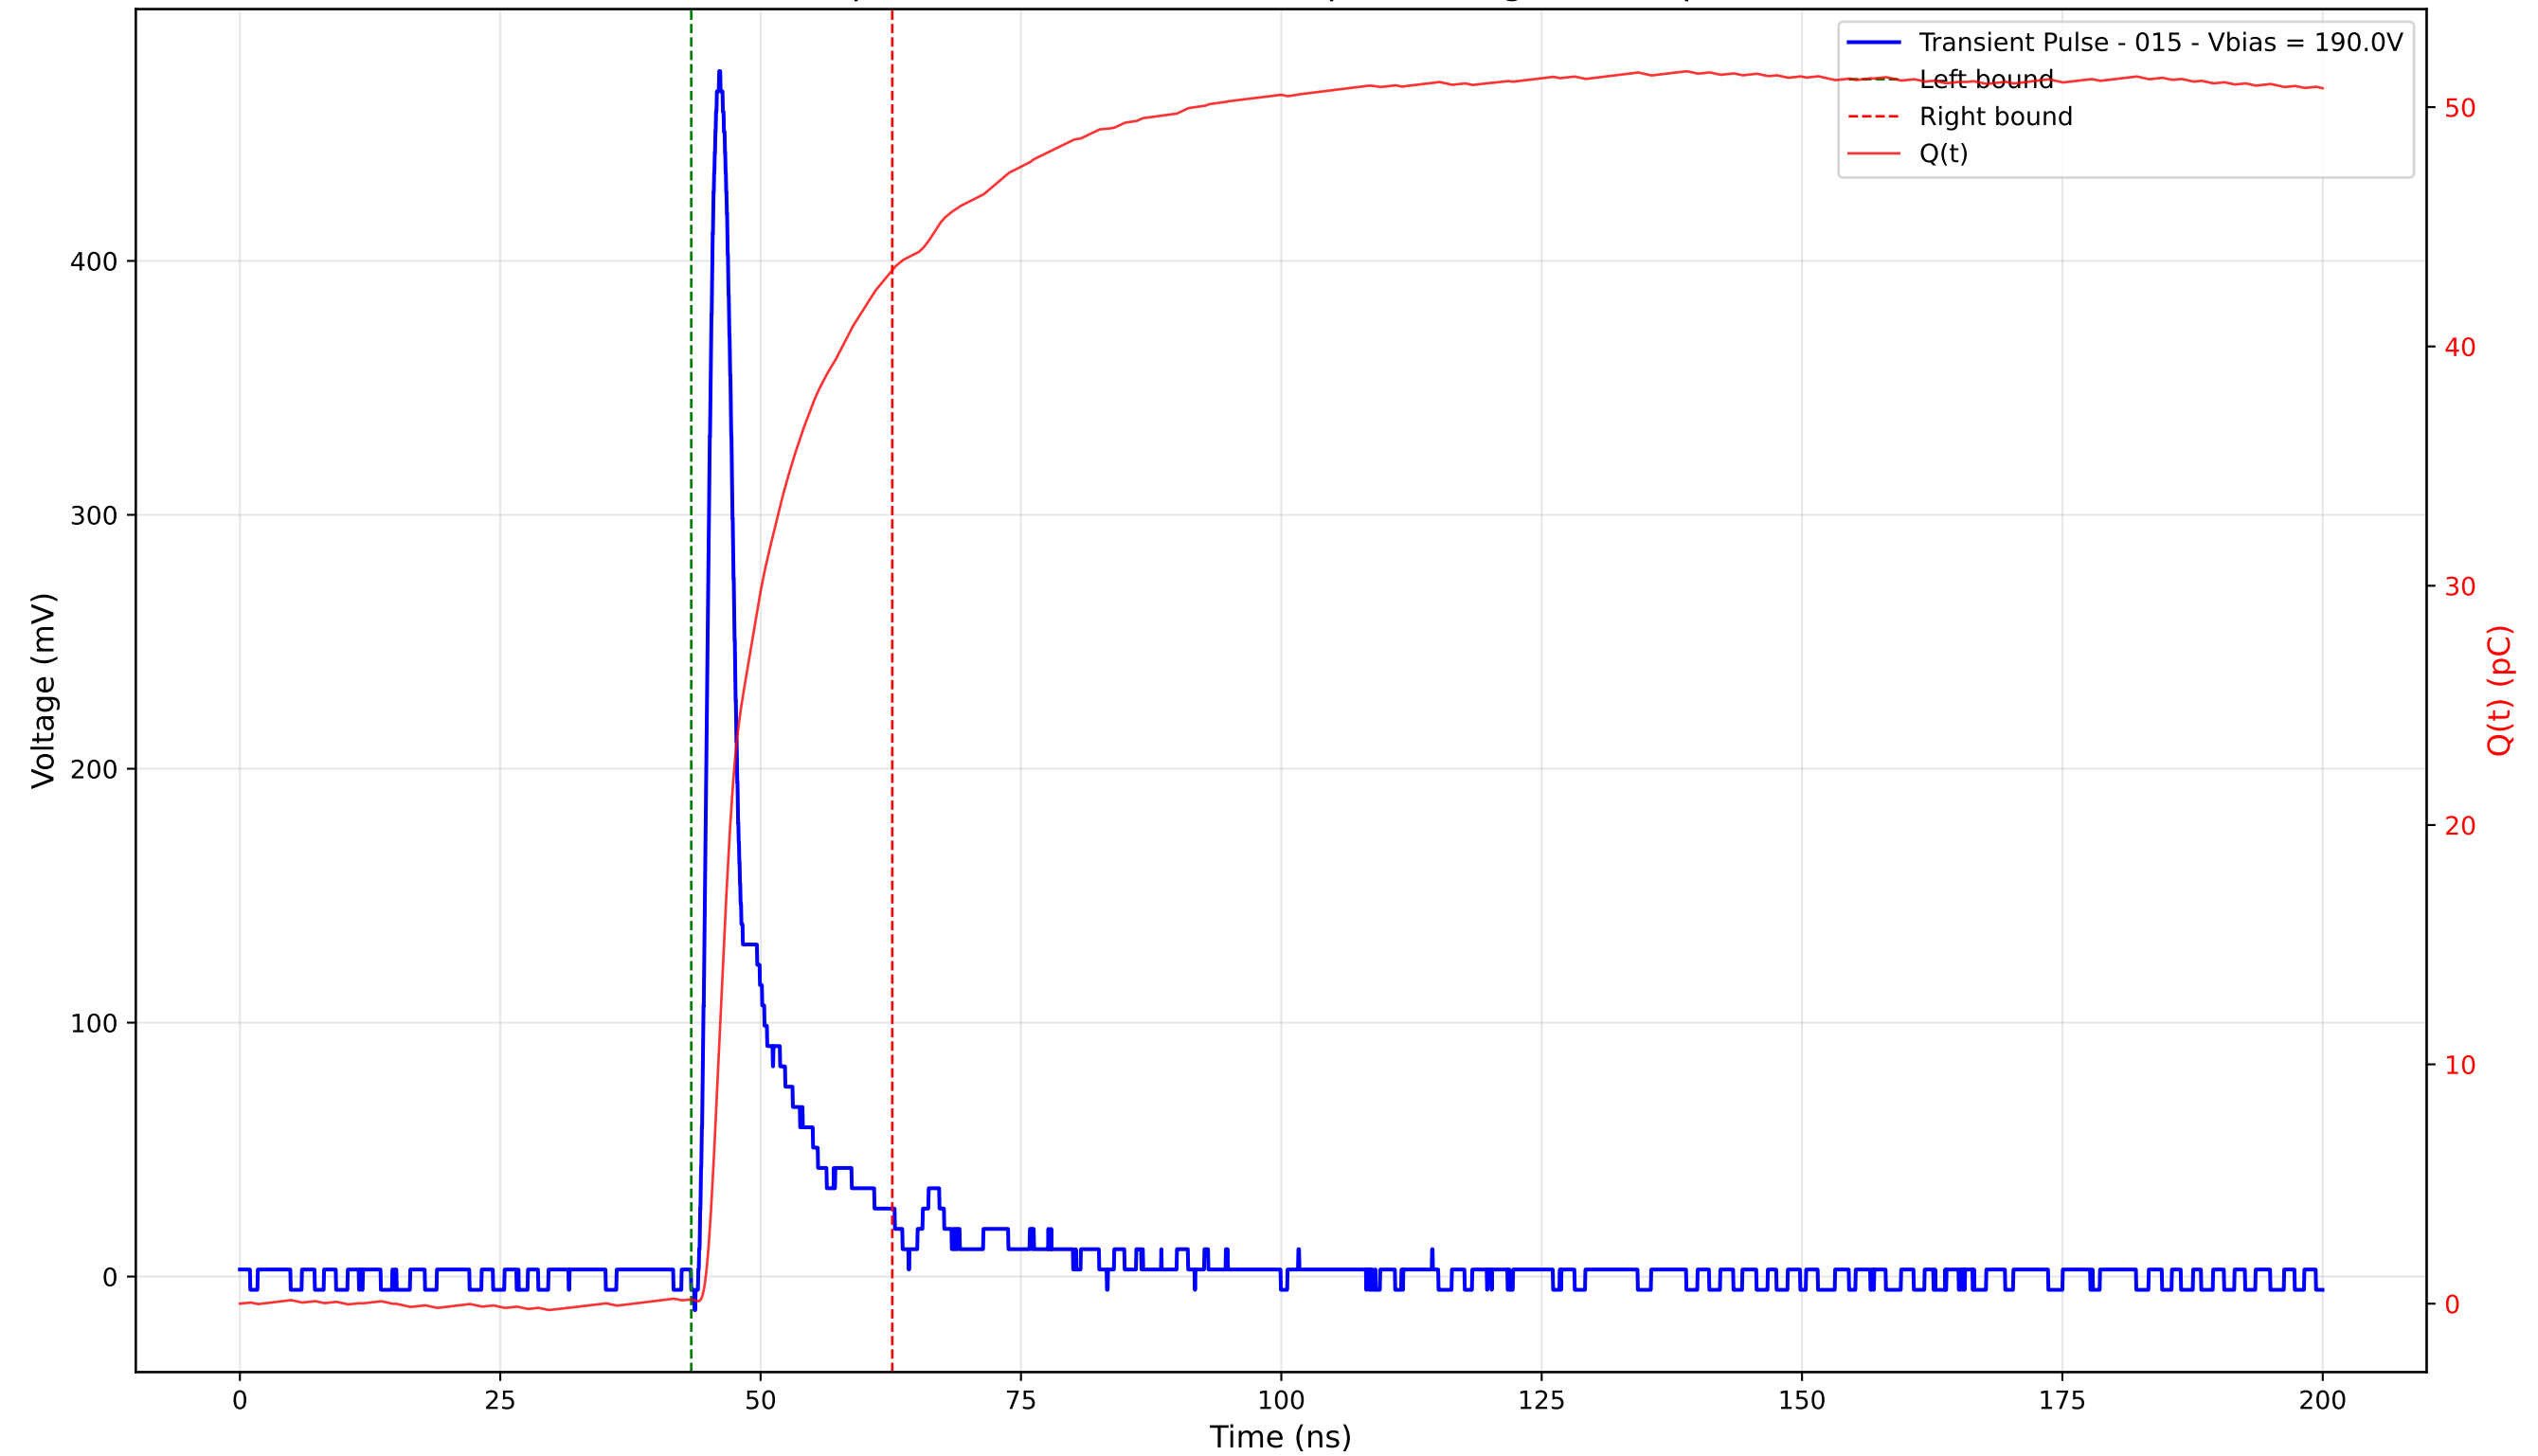


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 42.55 pC - Rise Time: 1.23 ns

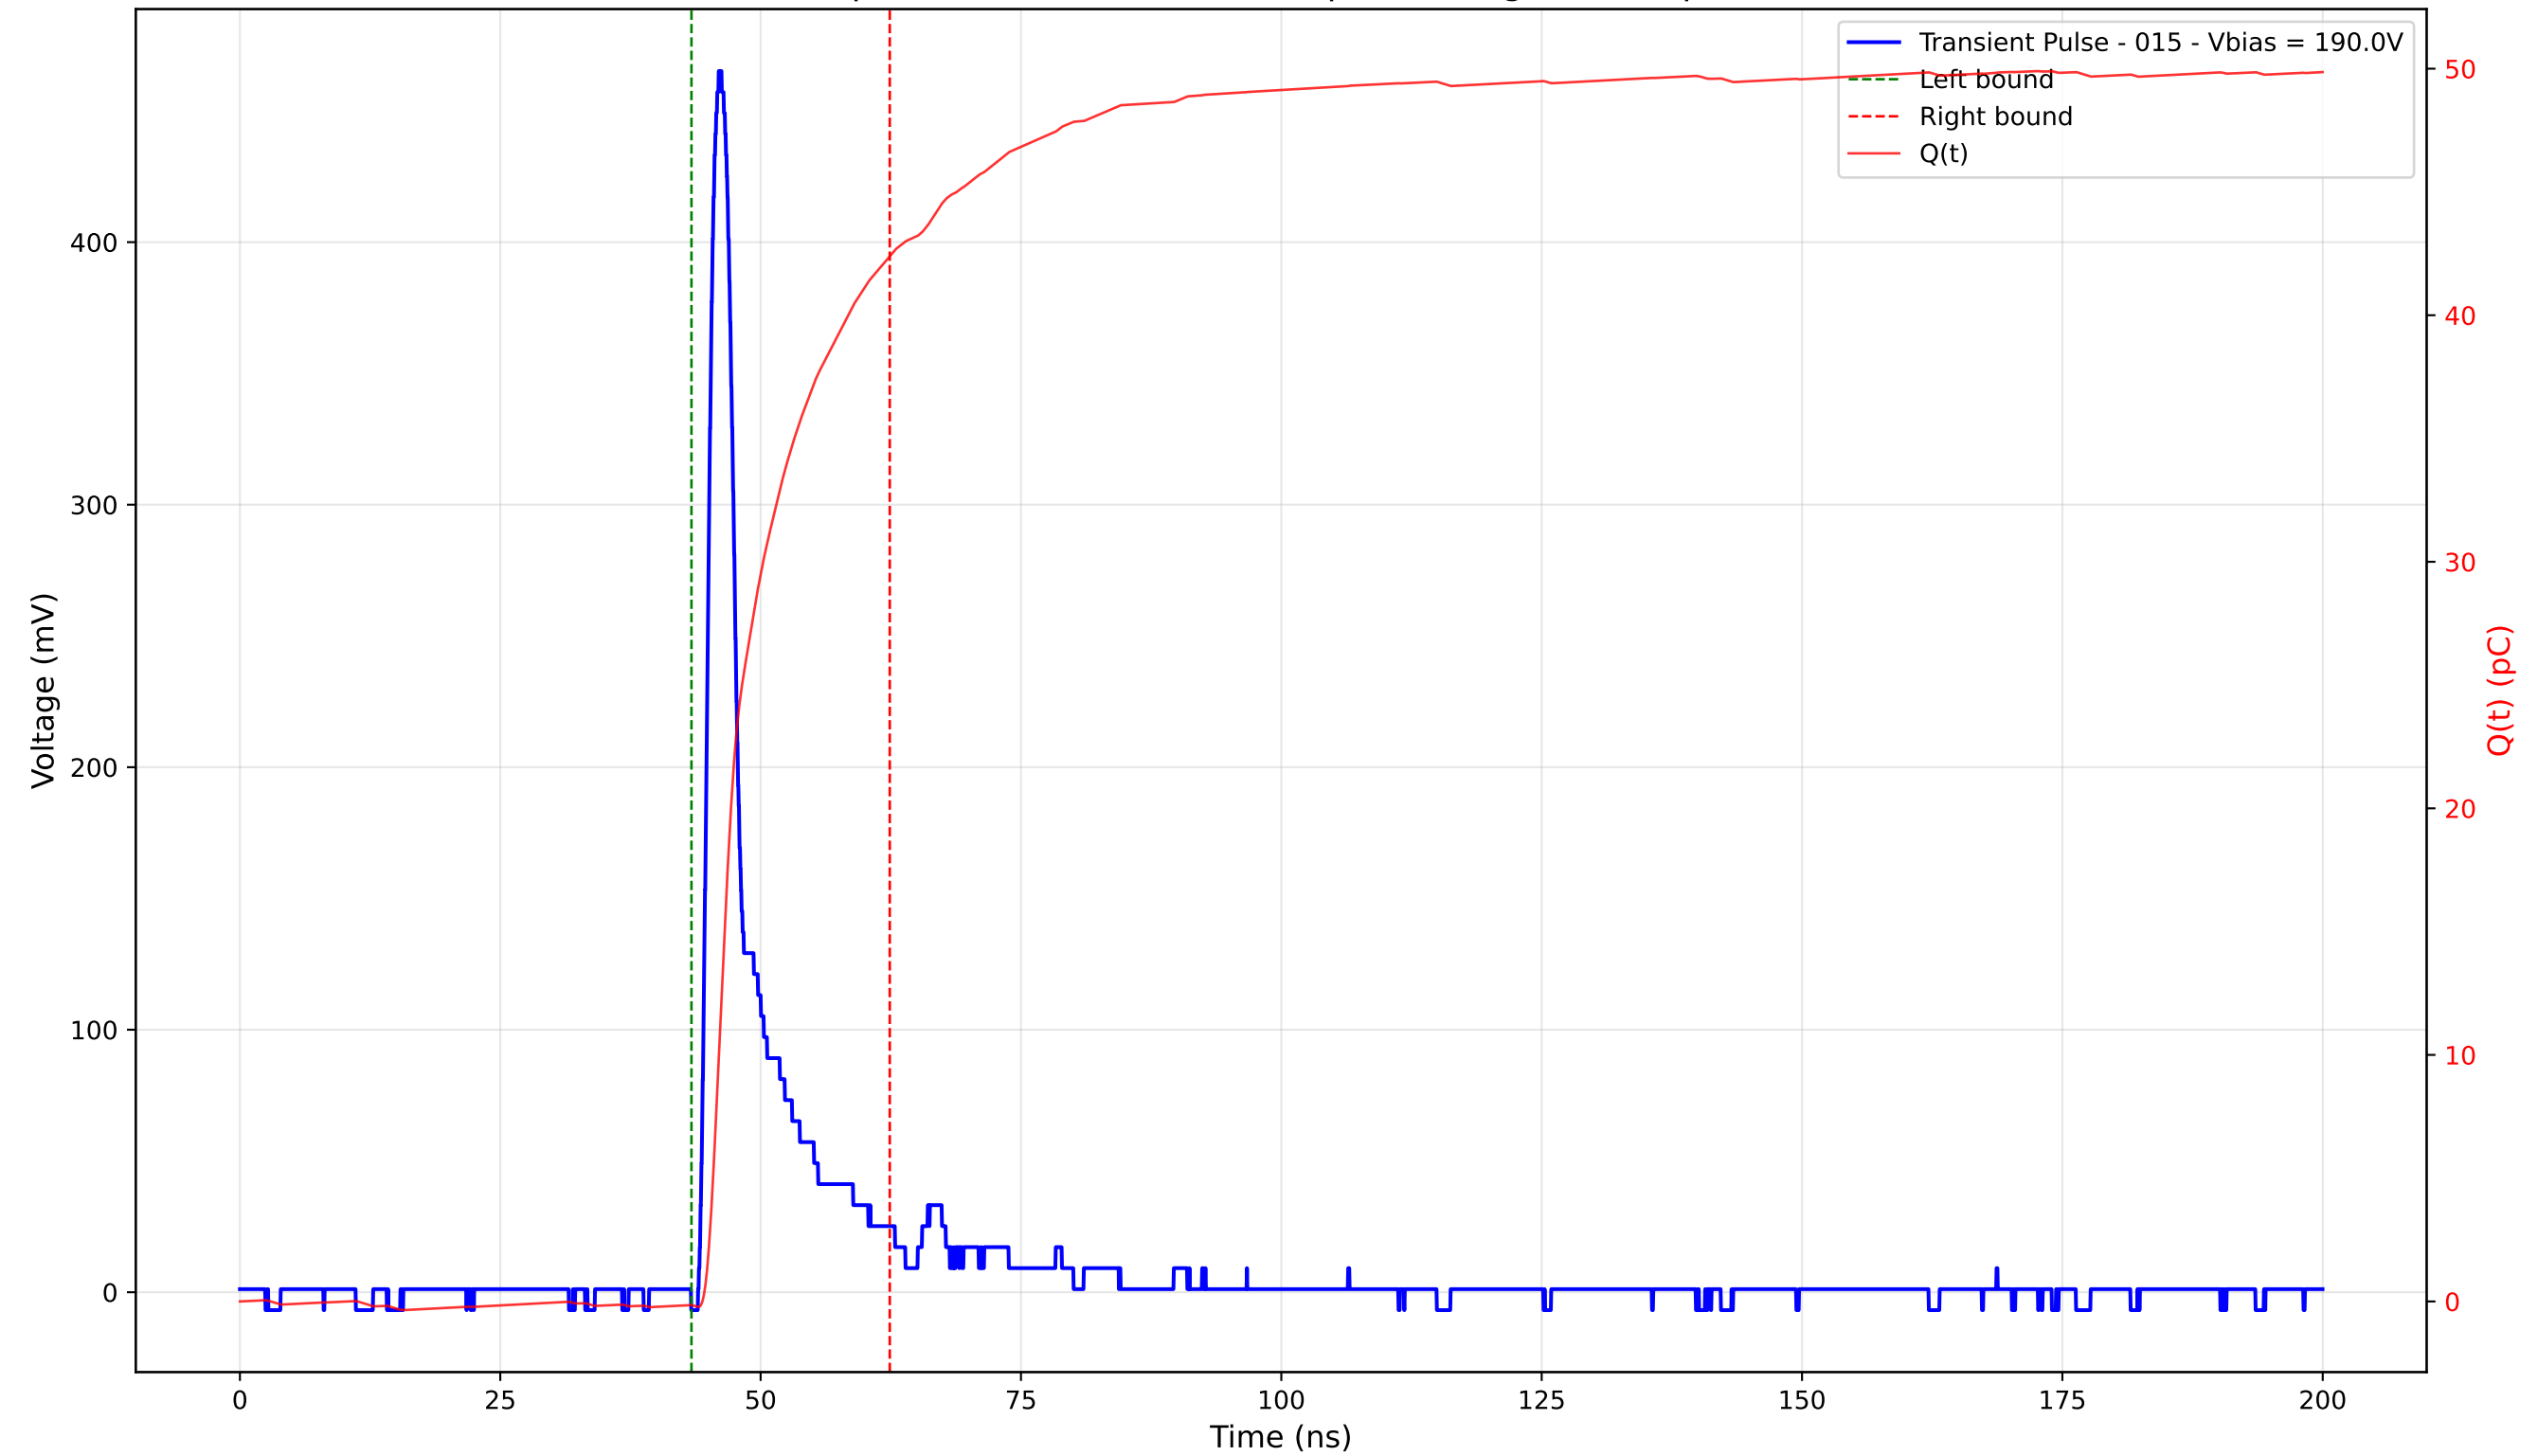


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 42.36 pC - Rise Time: 1.21 ns

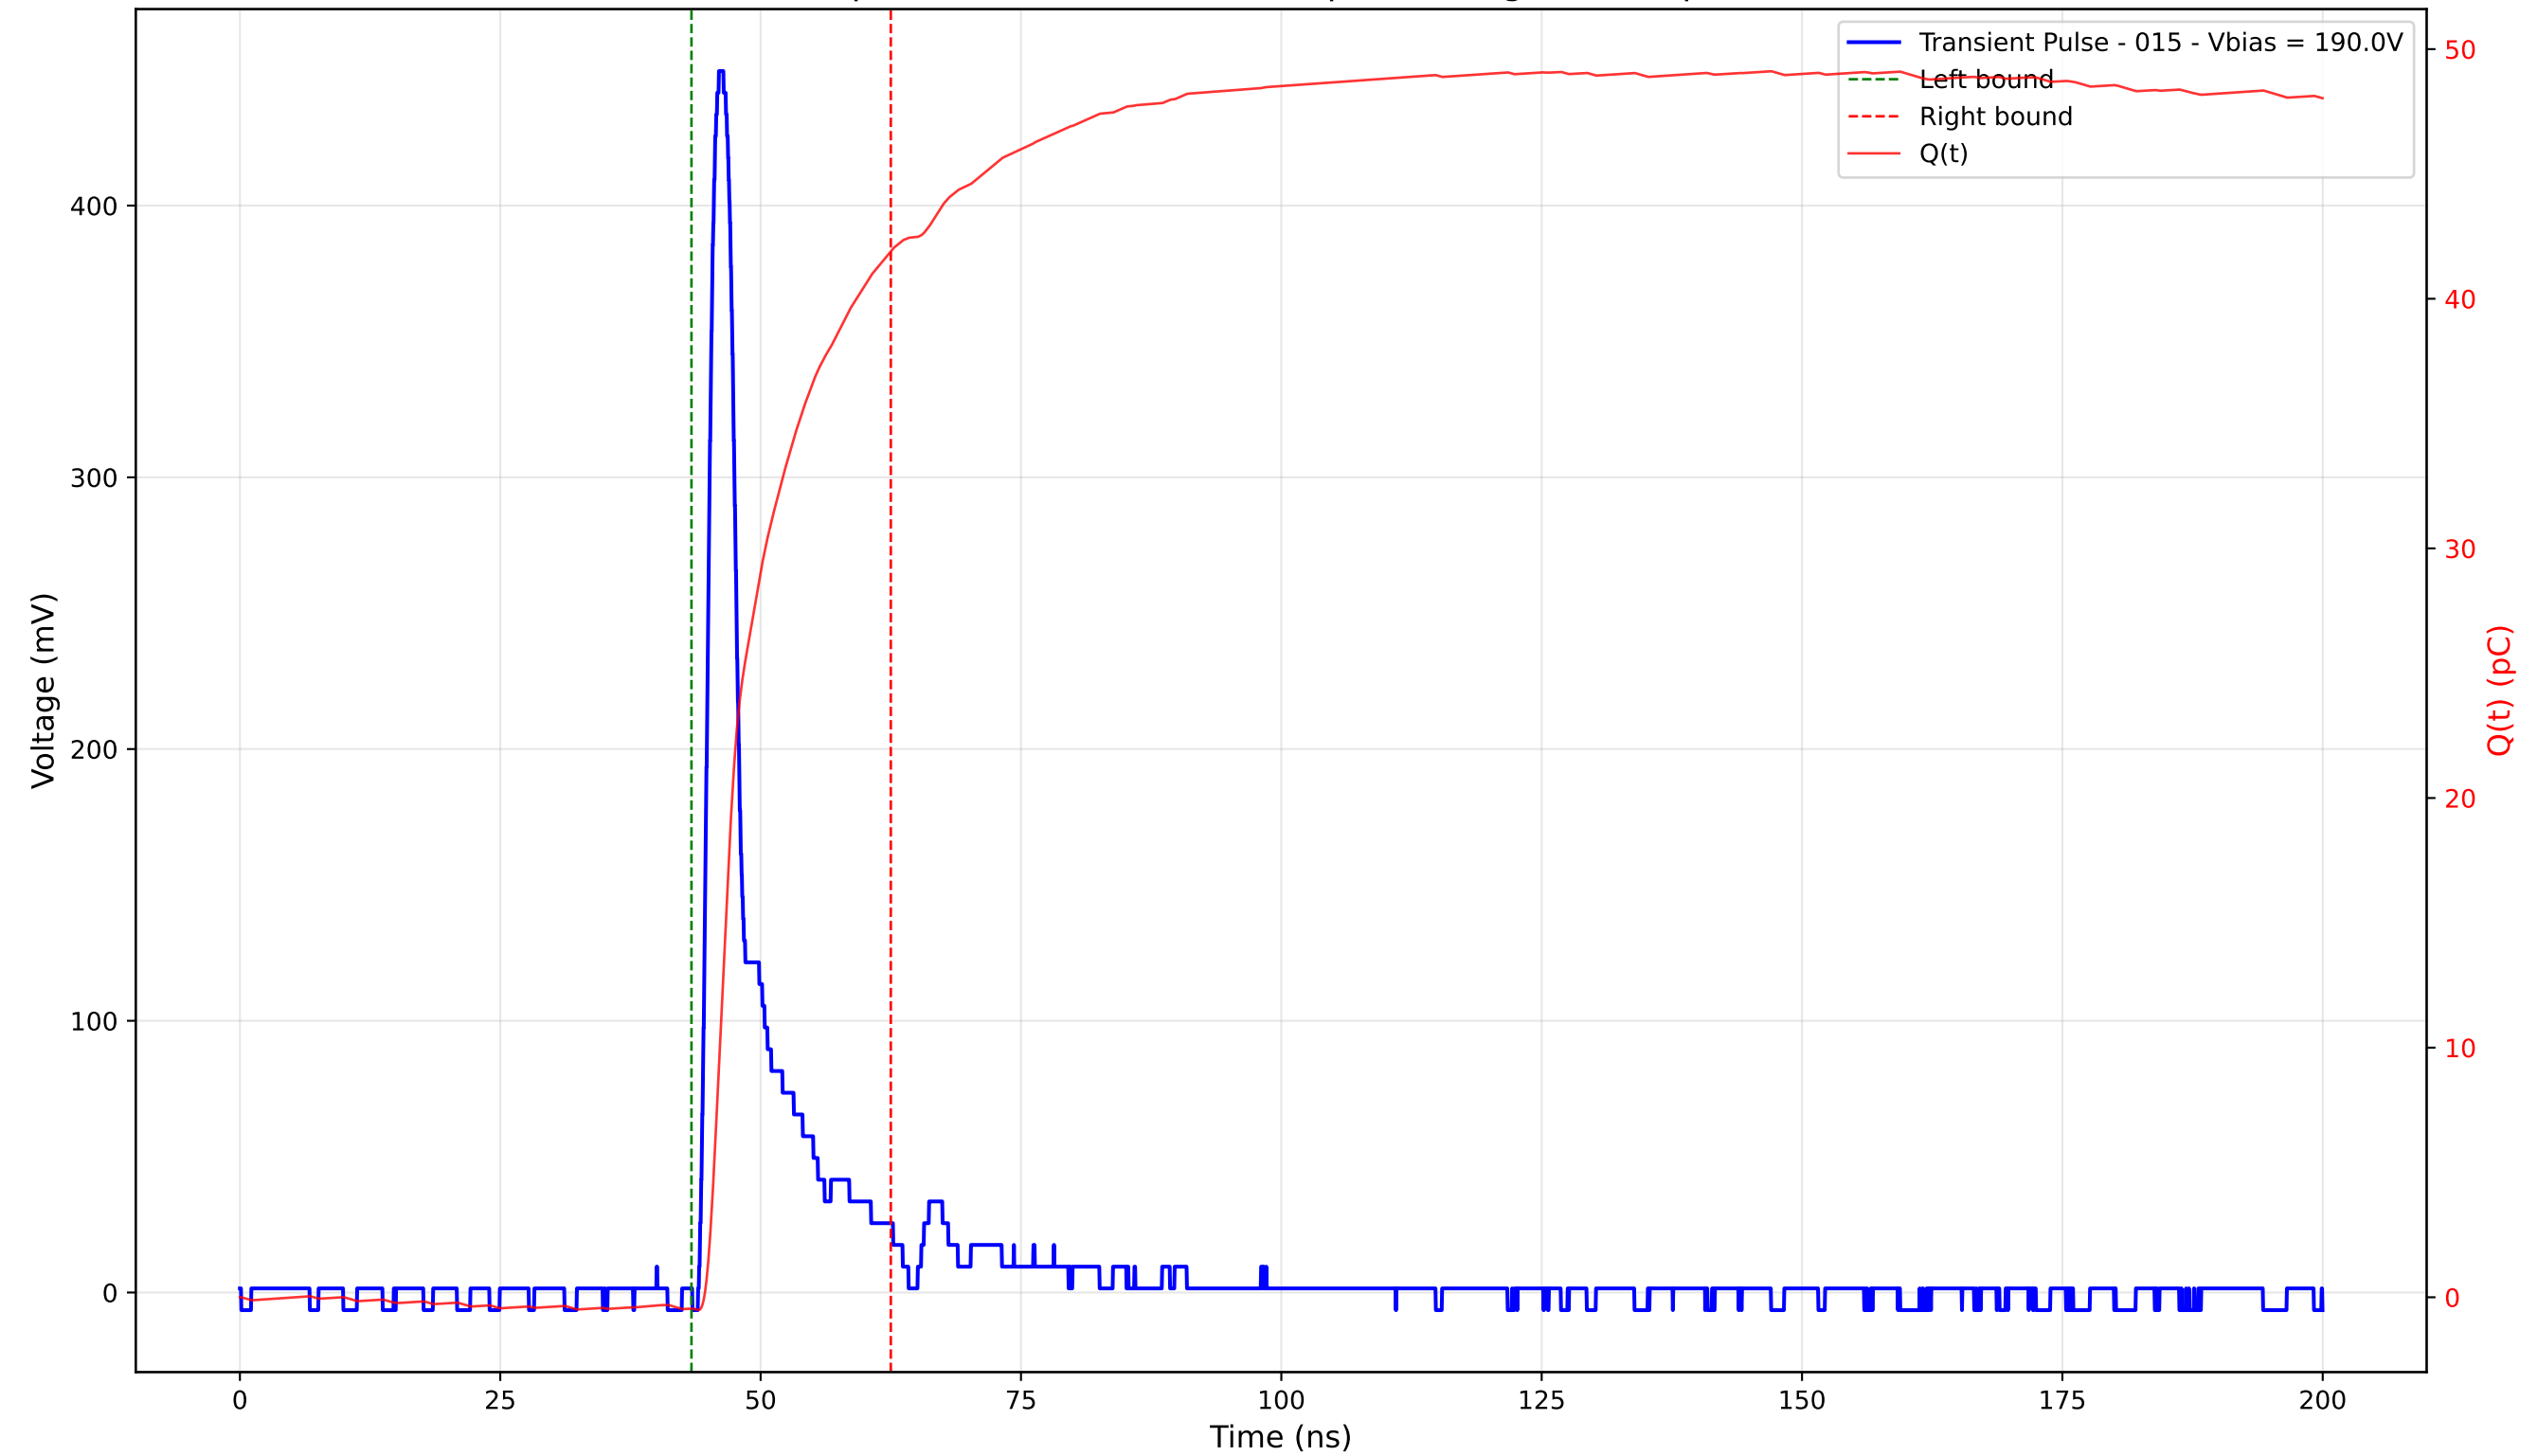


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 42.50 pC - Rise Time: 1.24 ns

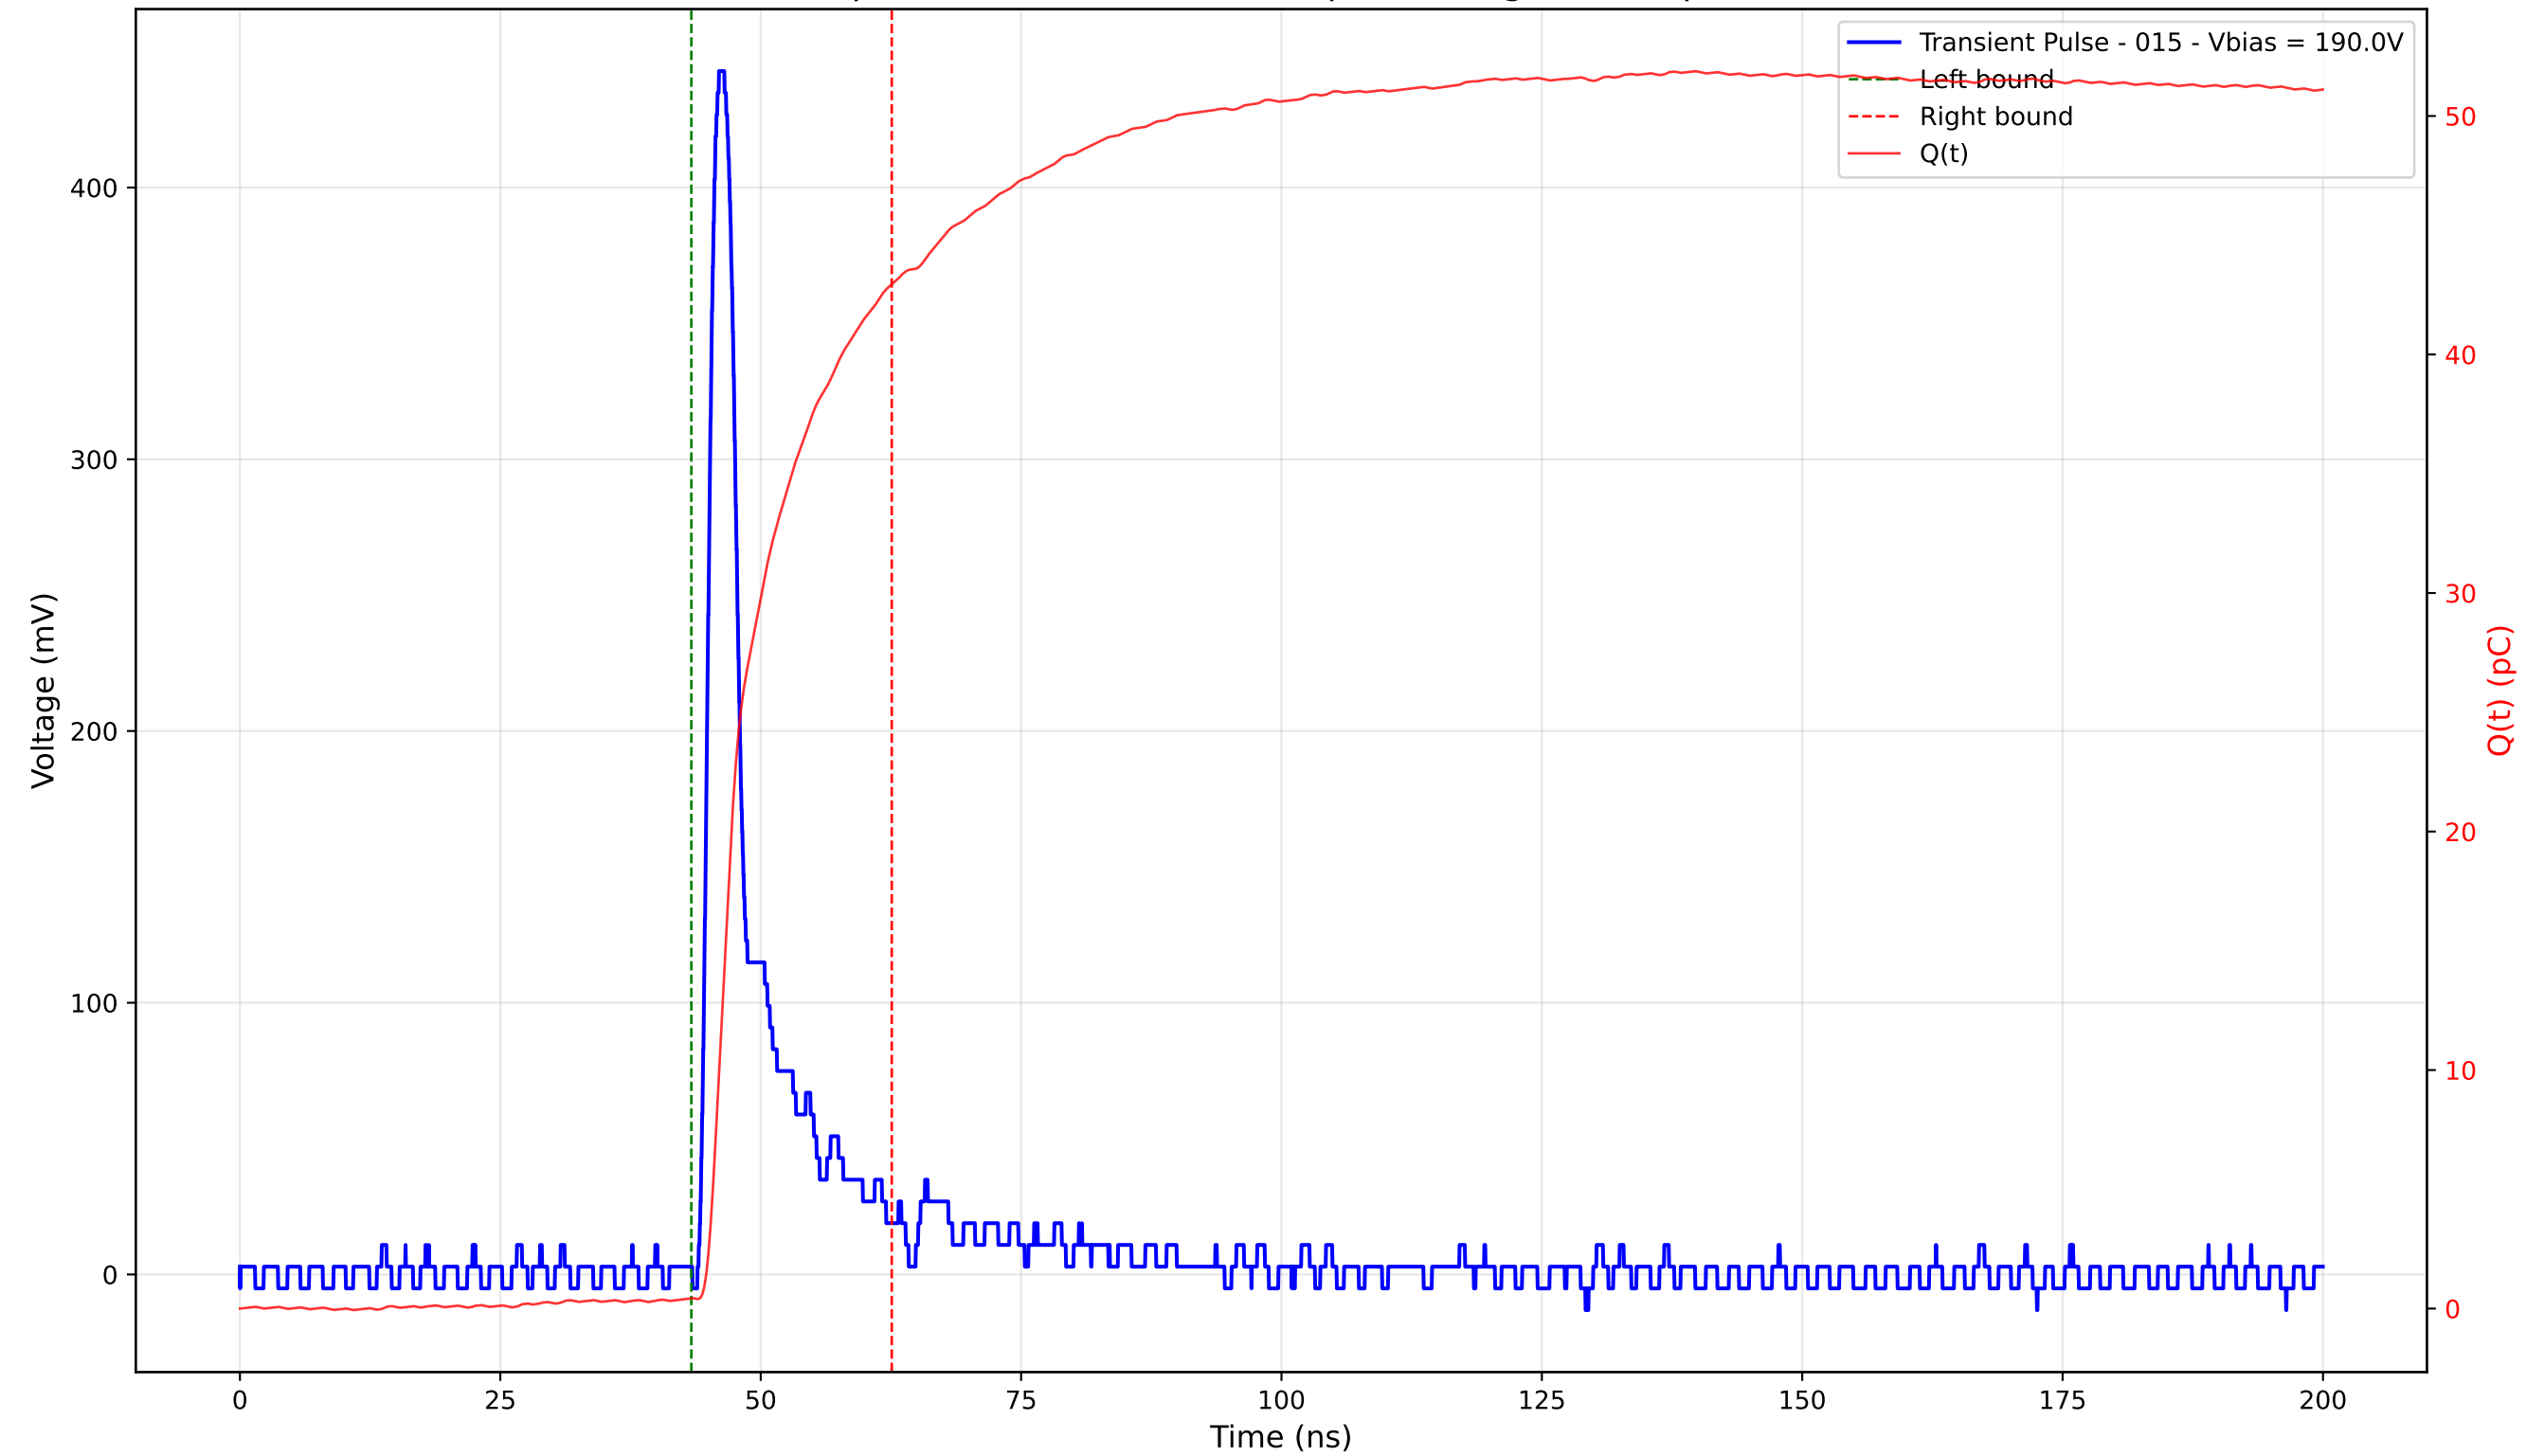


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 41.82 pC - Rise Time: 1.22 ns

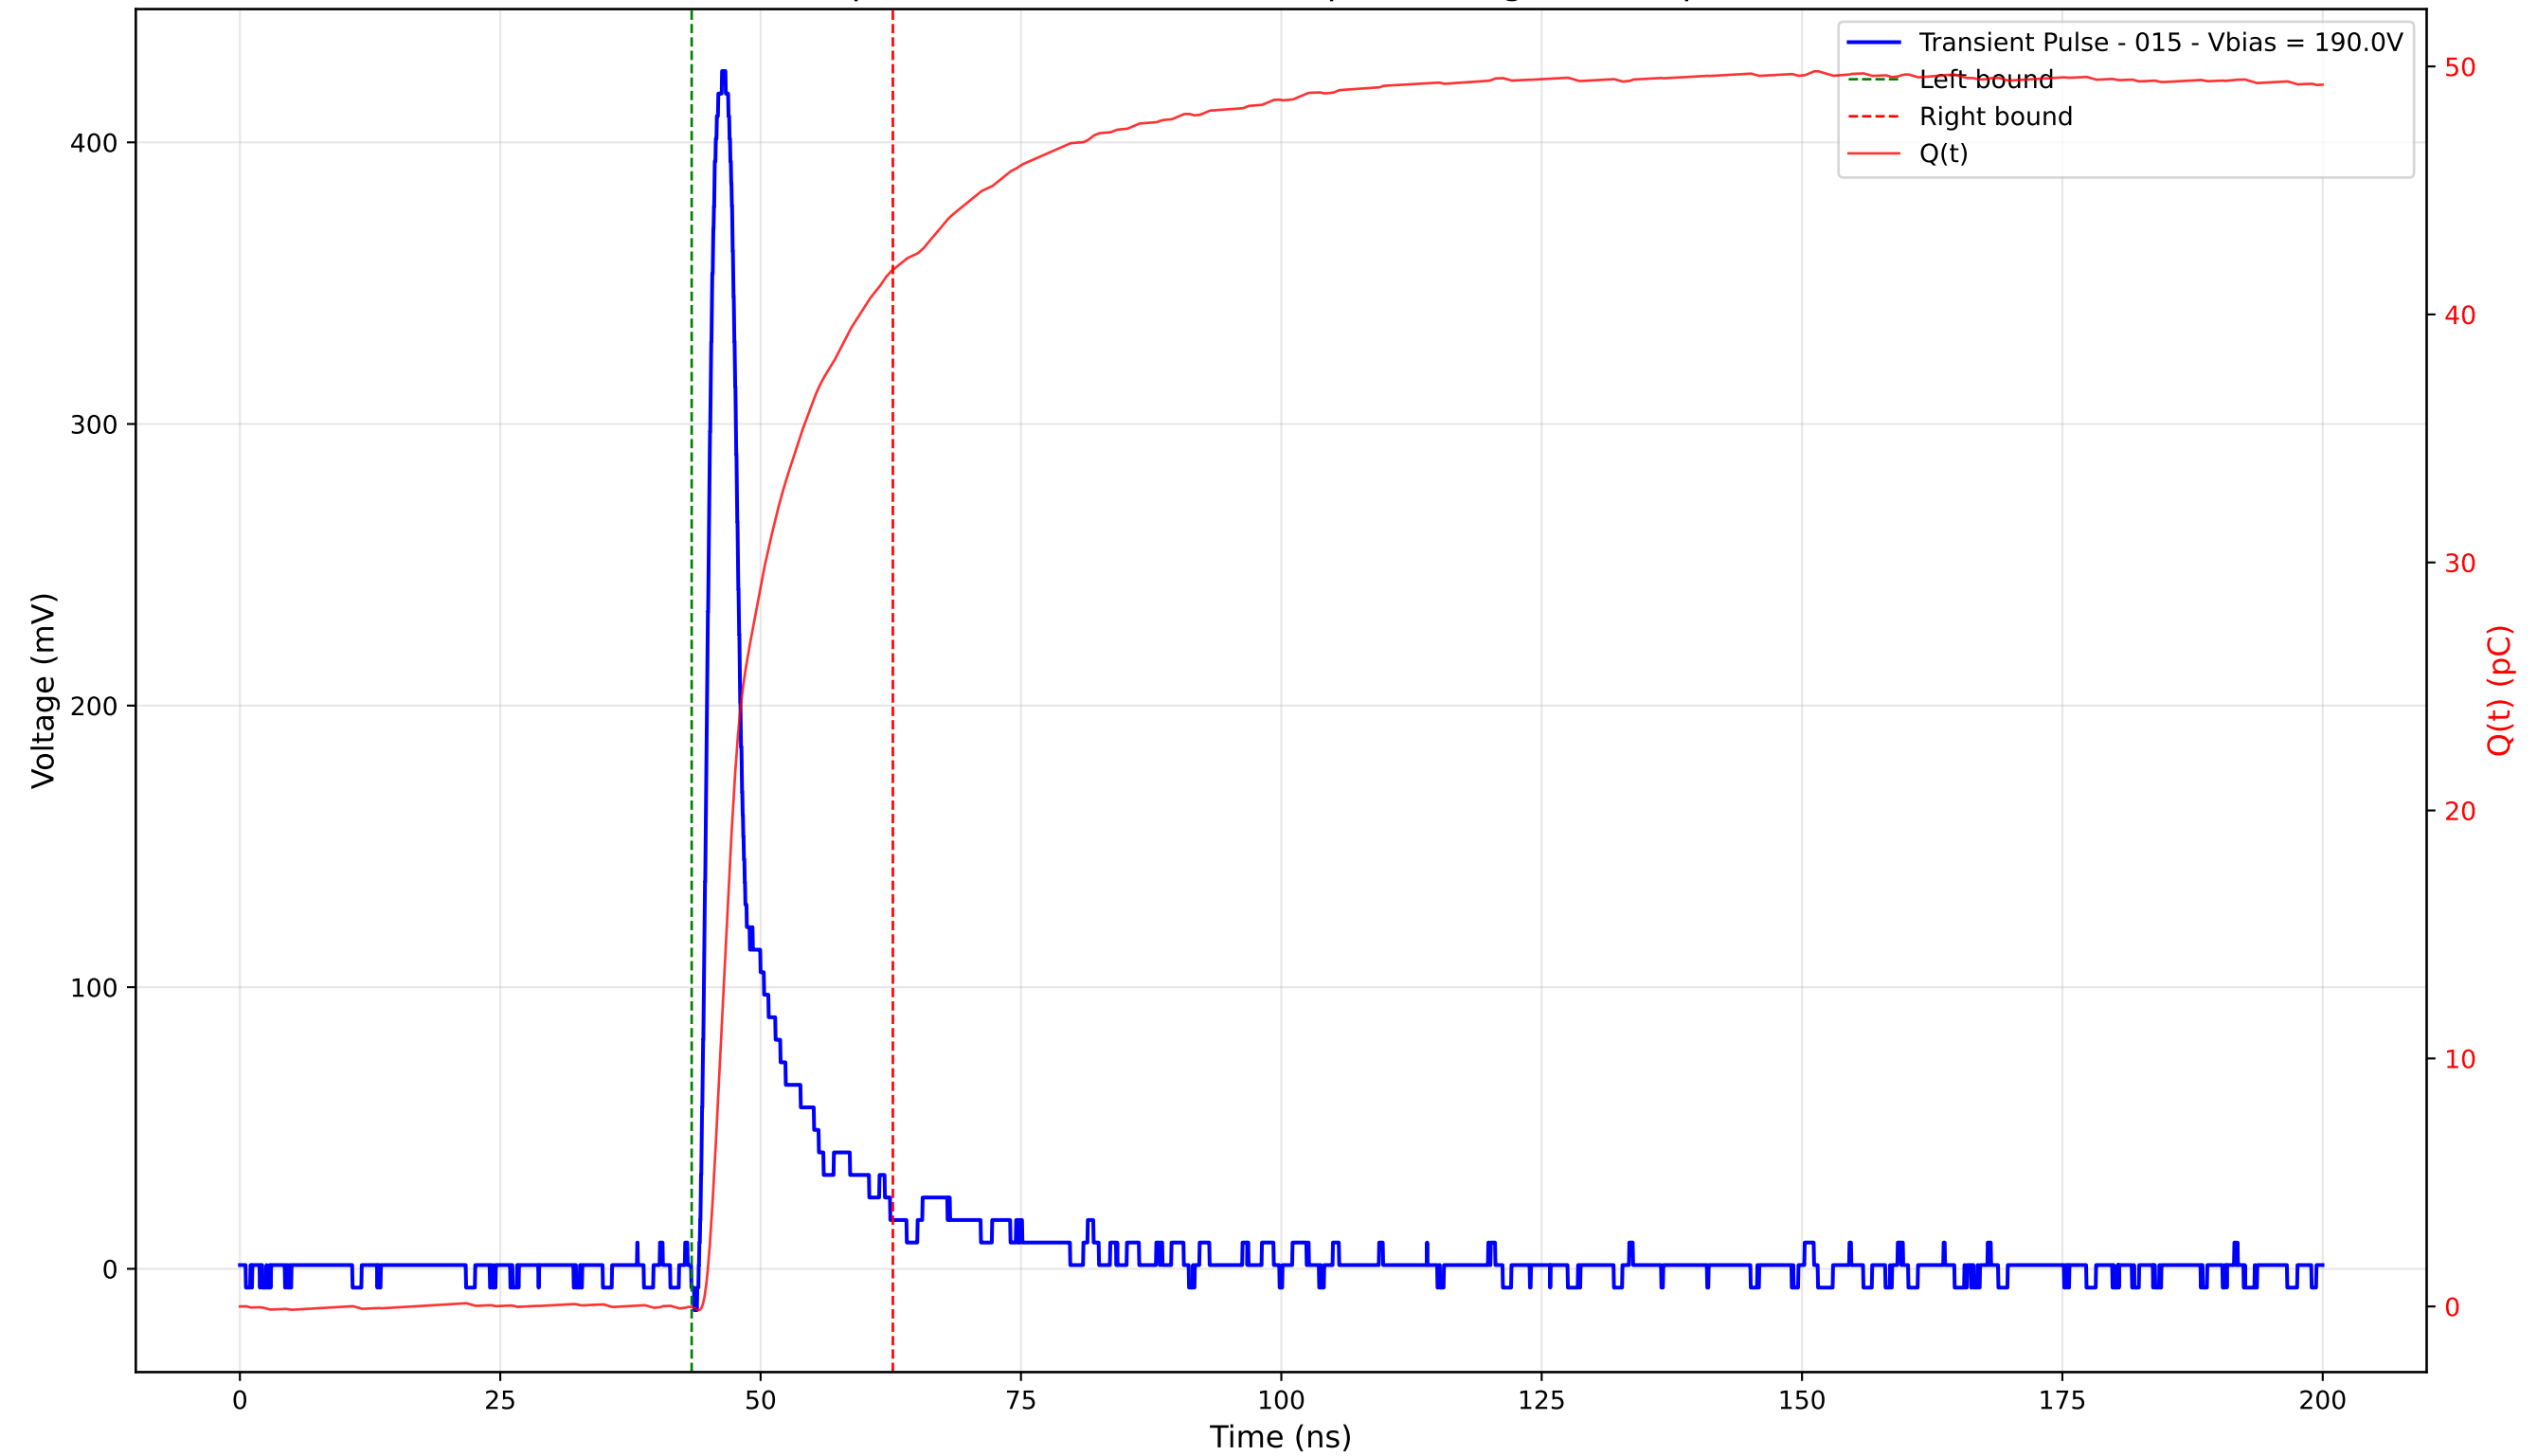


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 41.02 pC - Rise Time: 1.22 ns

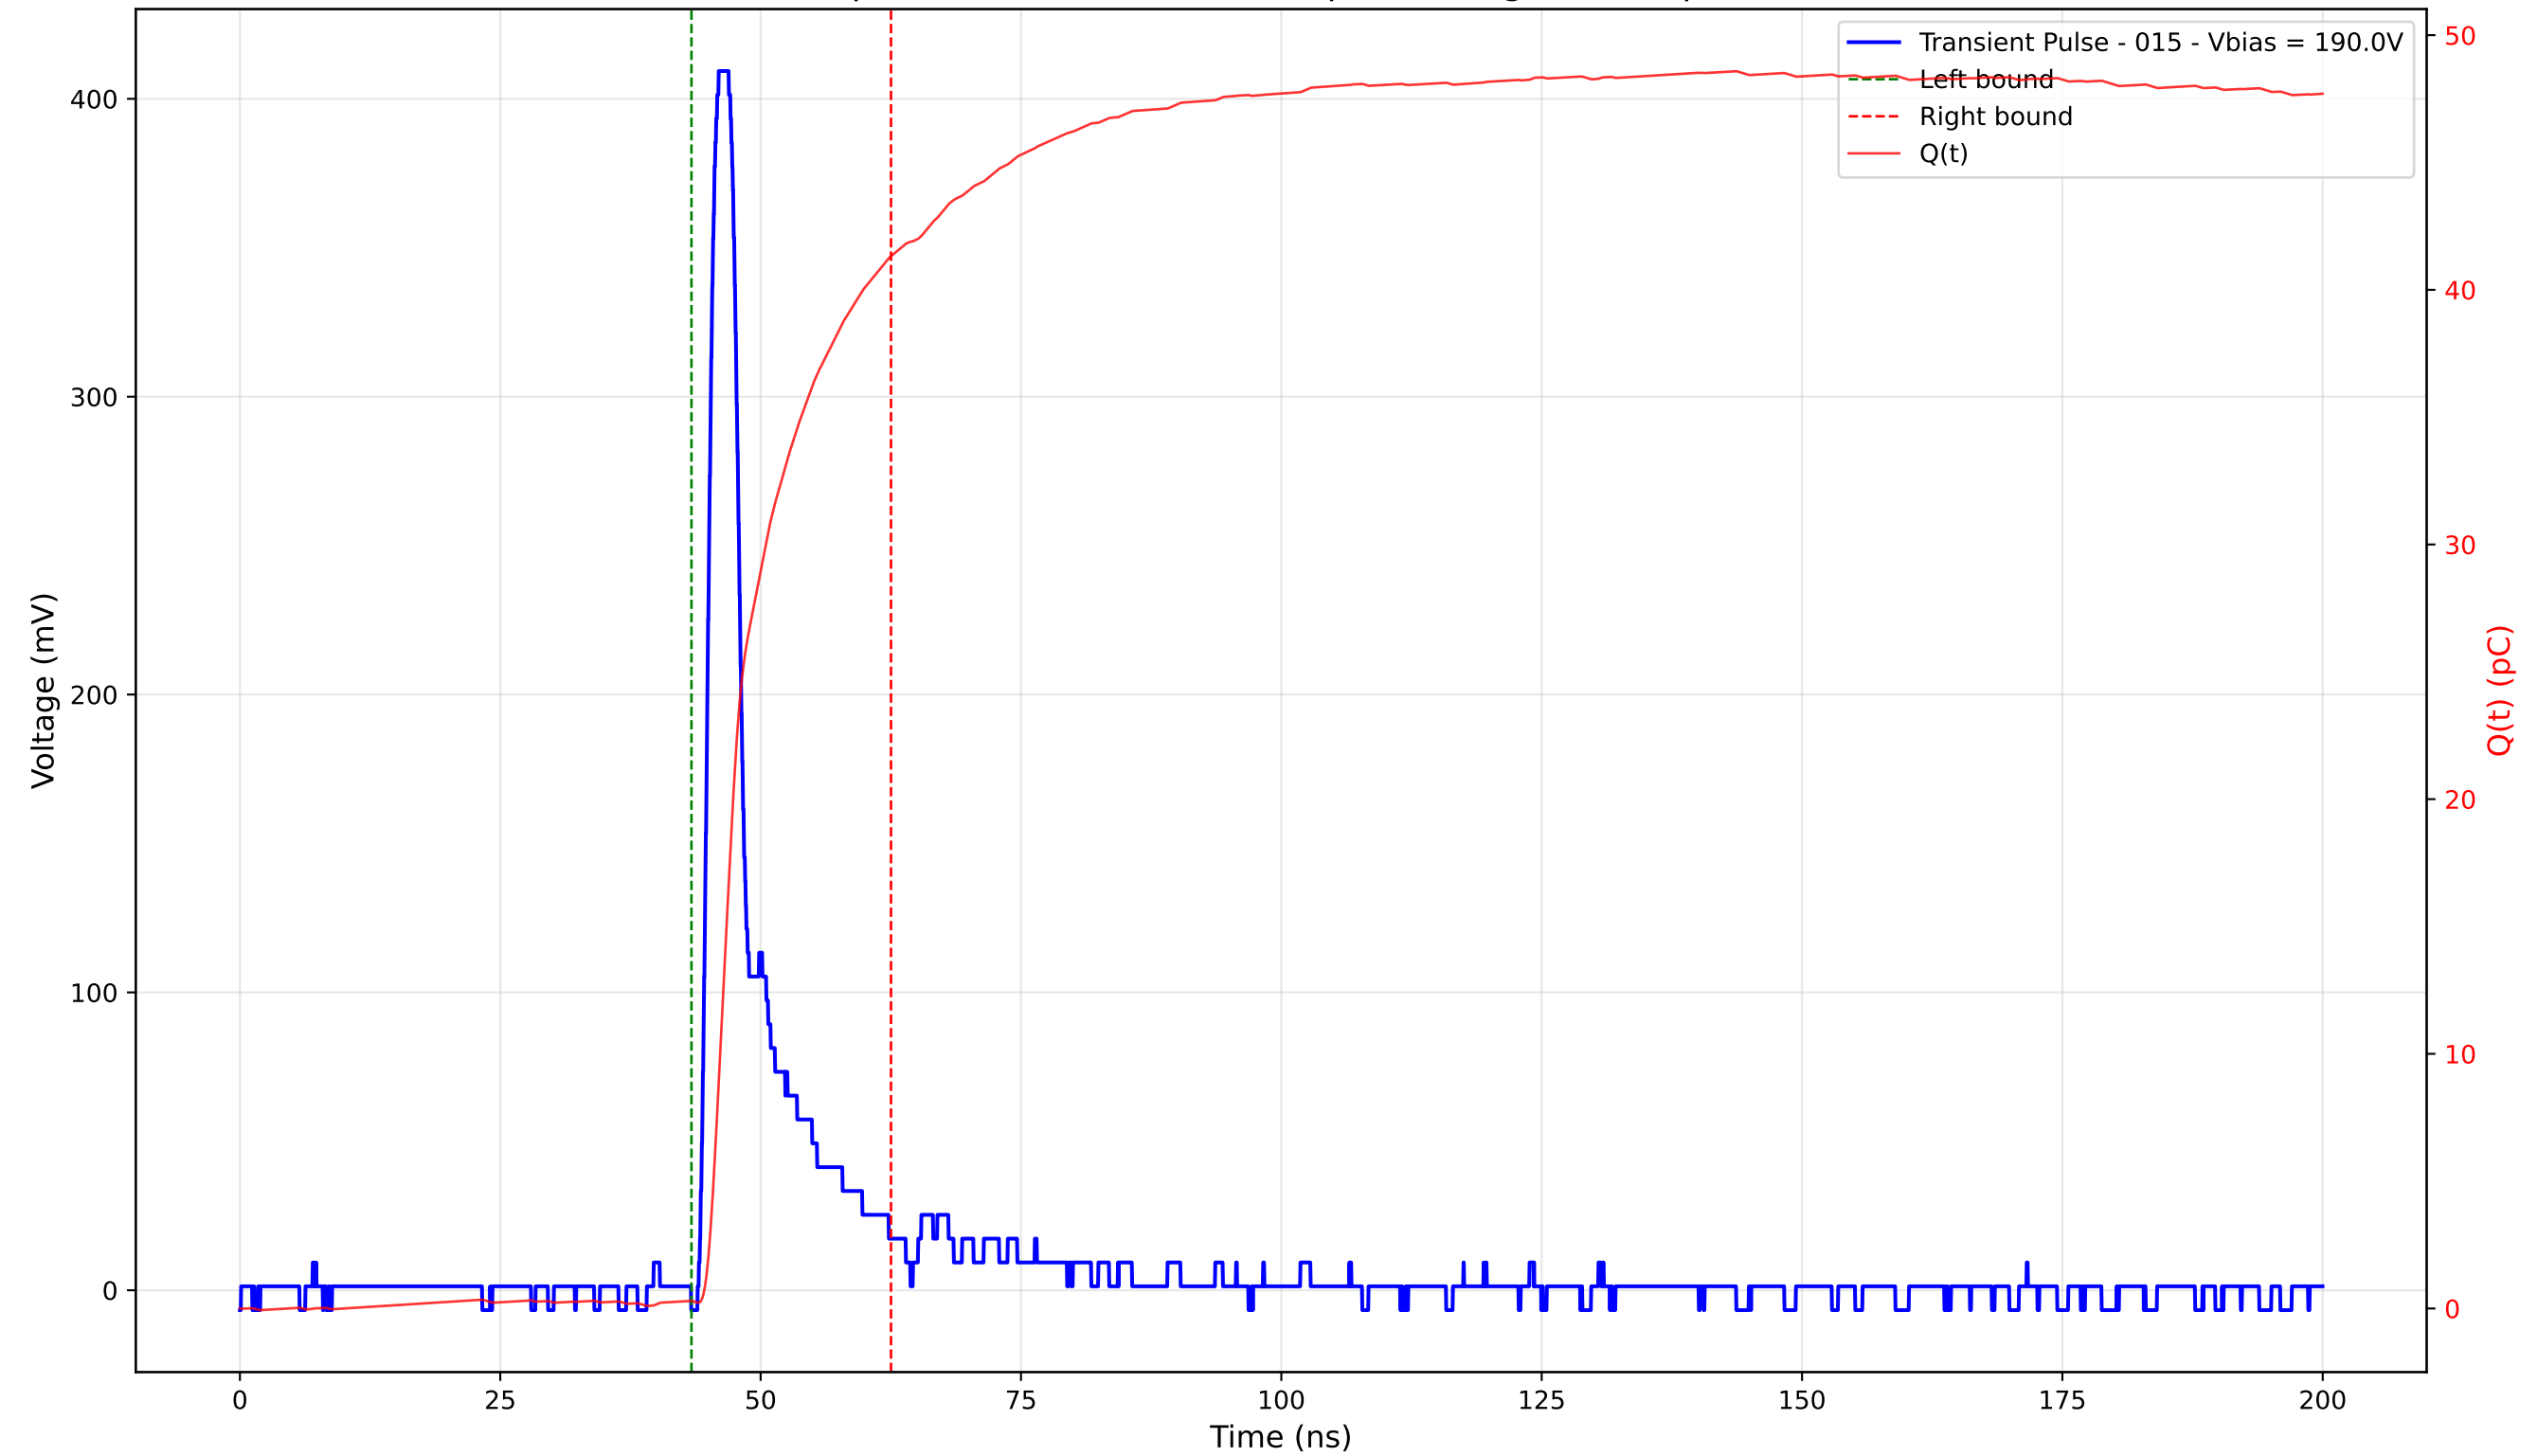


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 40.16 pC - Rise Time: 1.24 ns

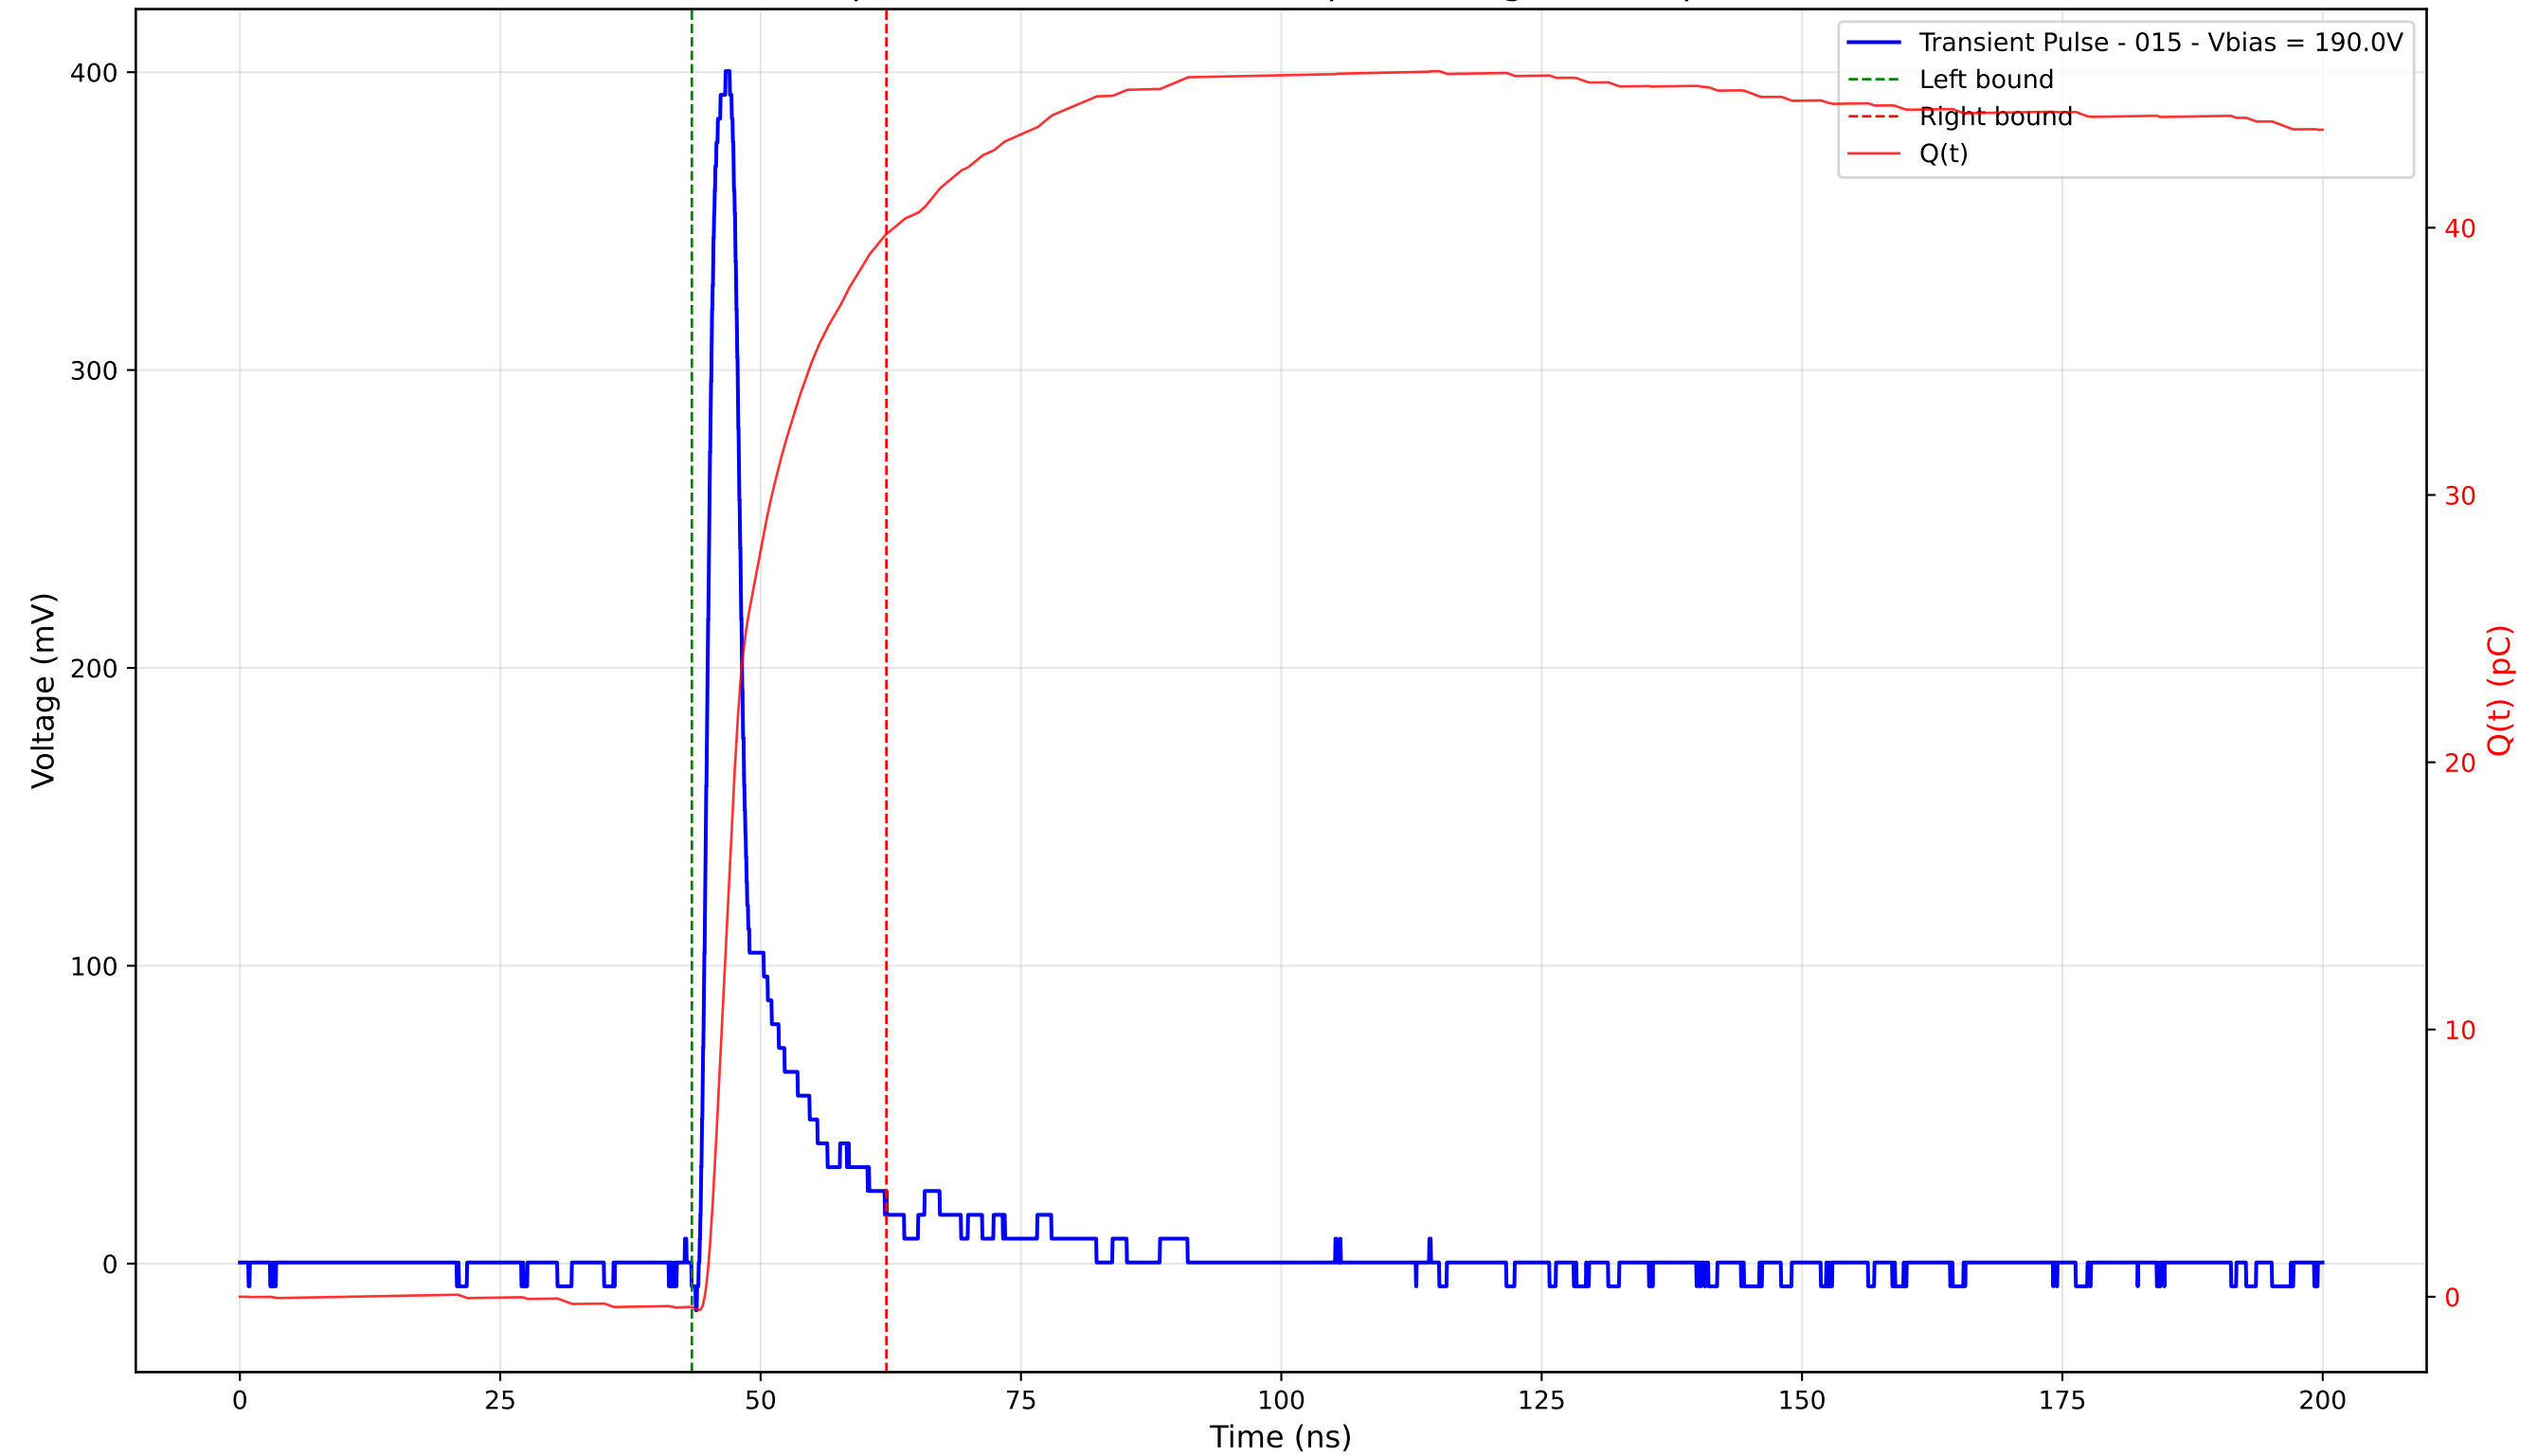


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 40.31 pC - Rise Time: 1.31 ns

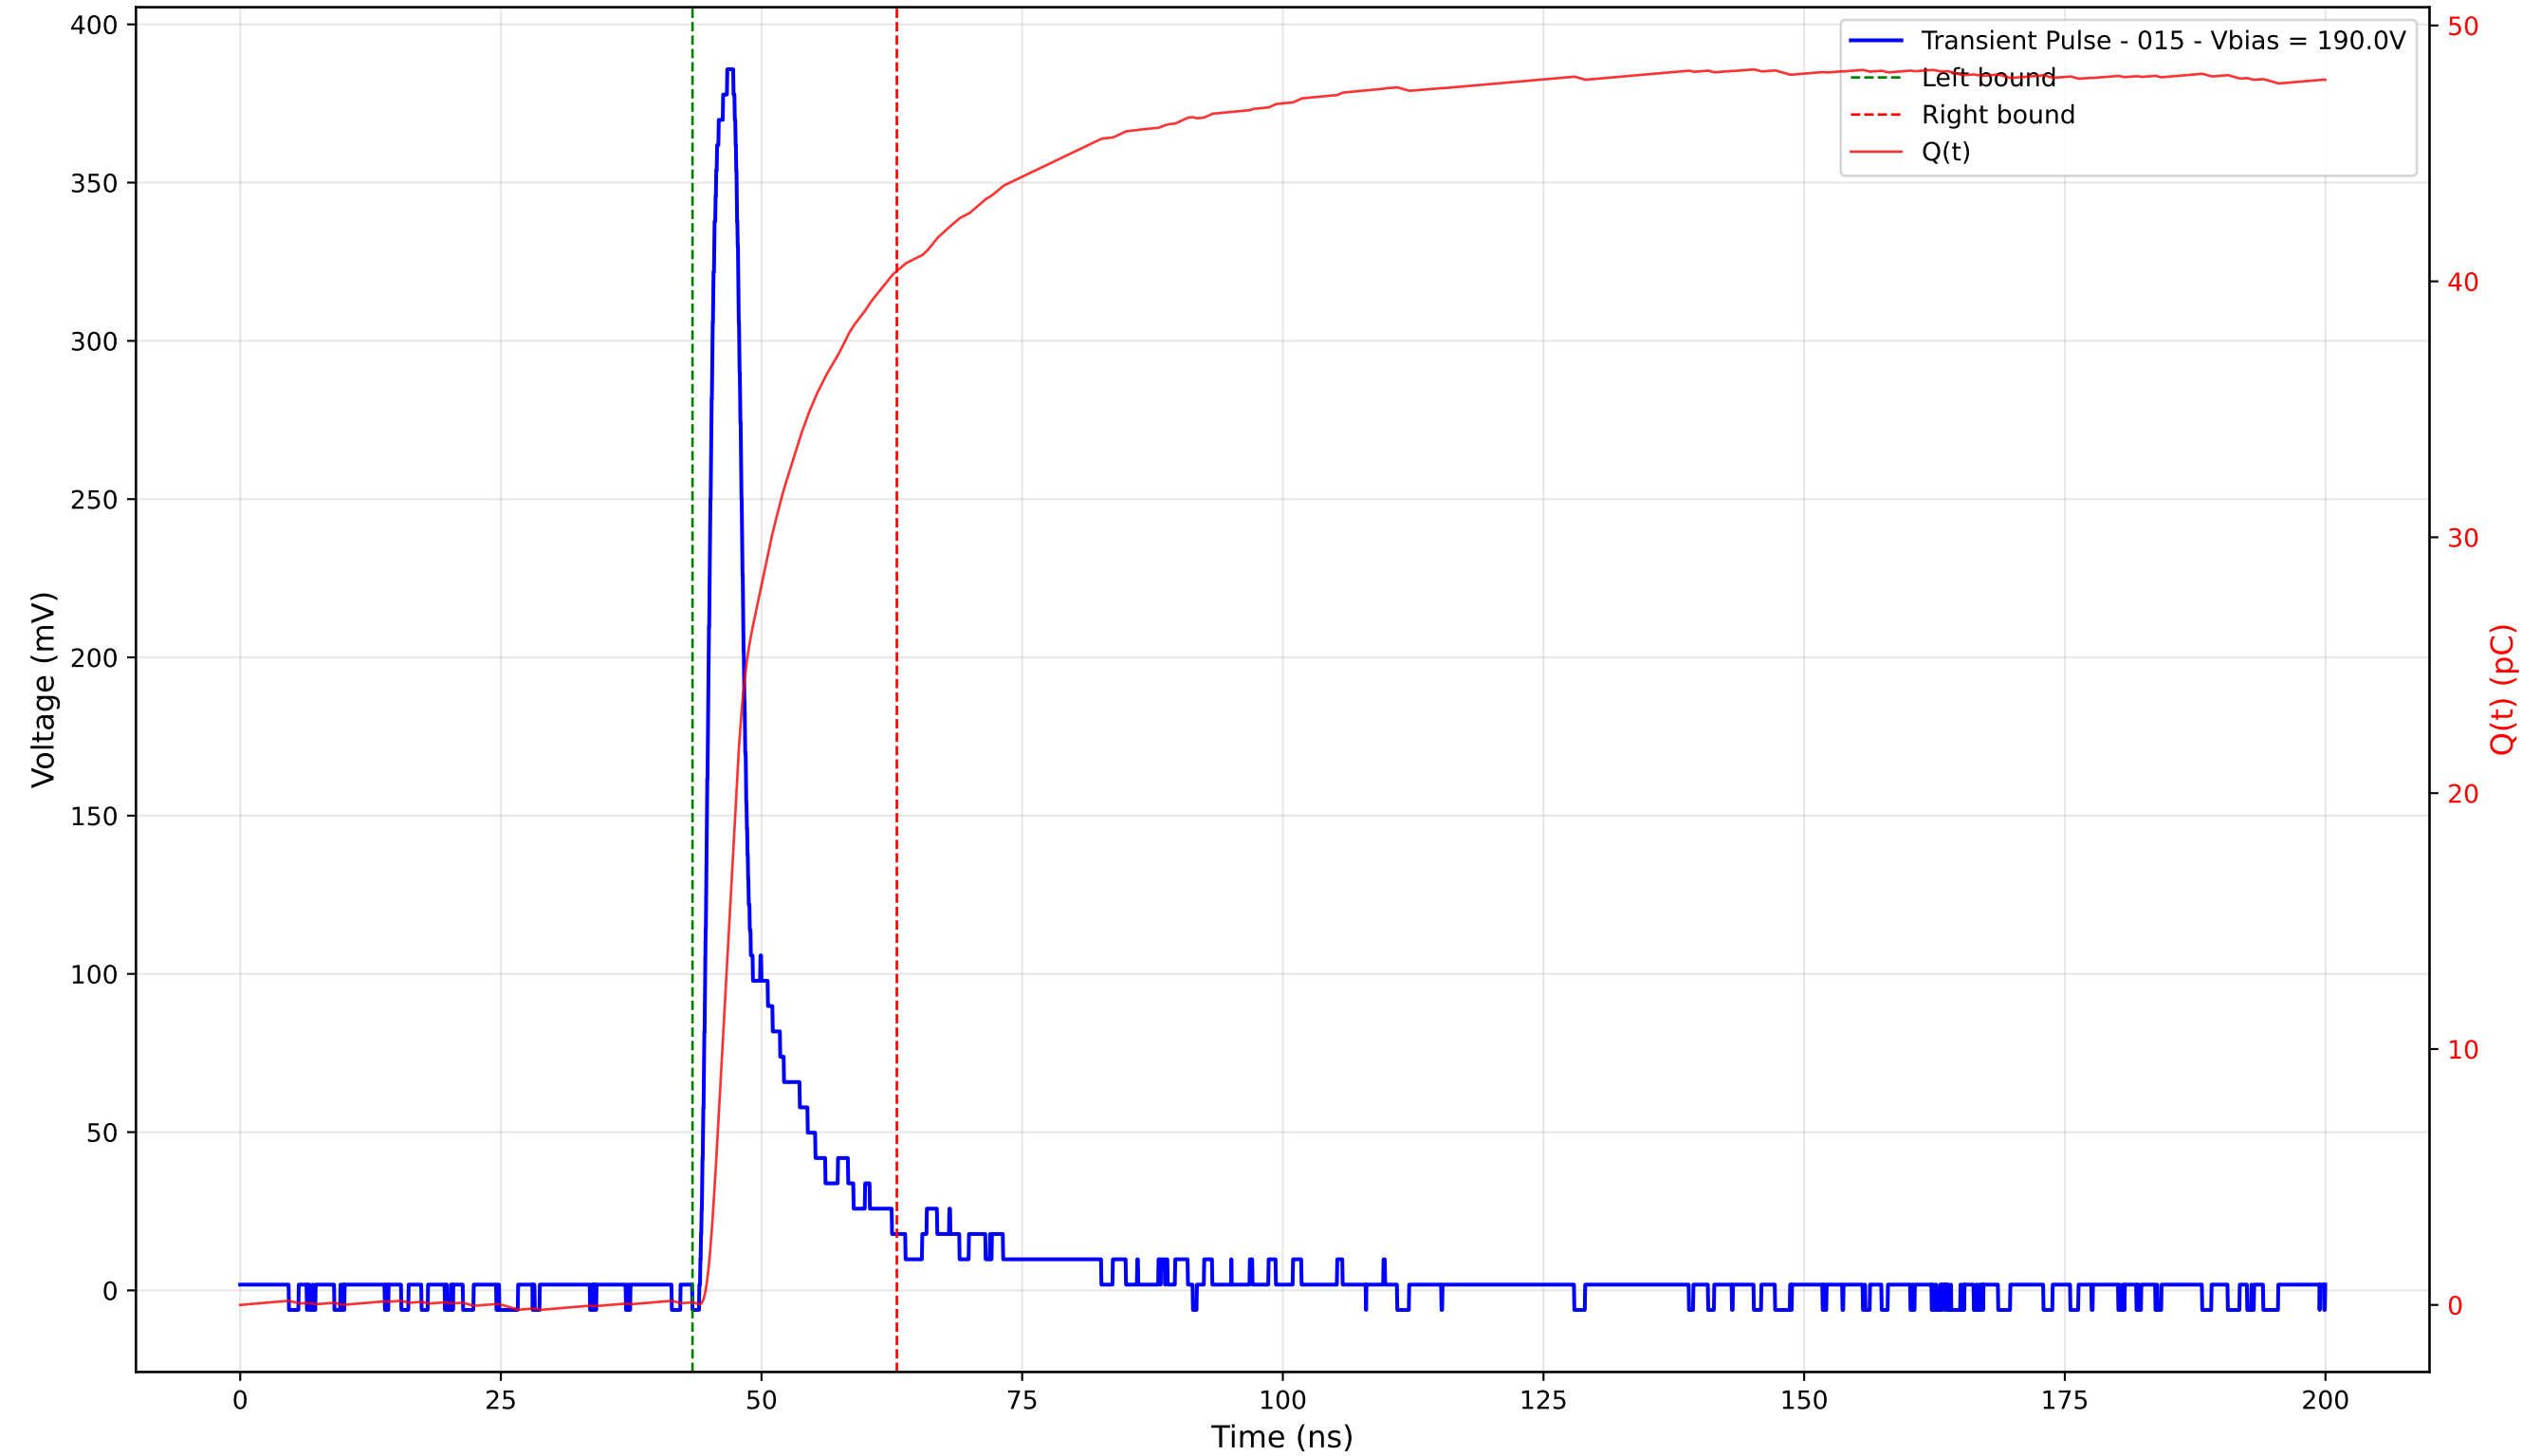


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 38.47 pC - Rise Time: 1.41 ns

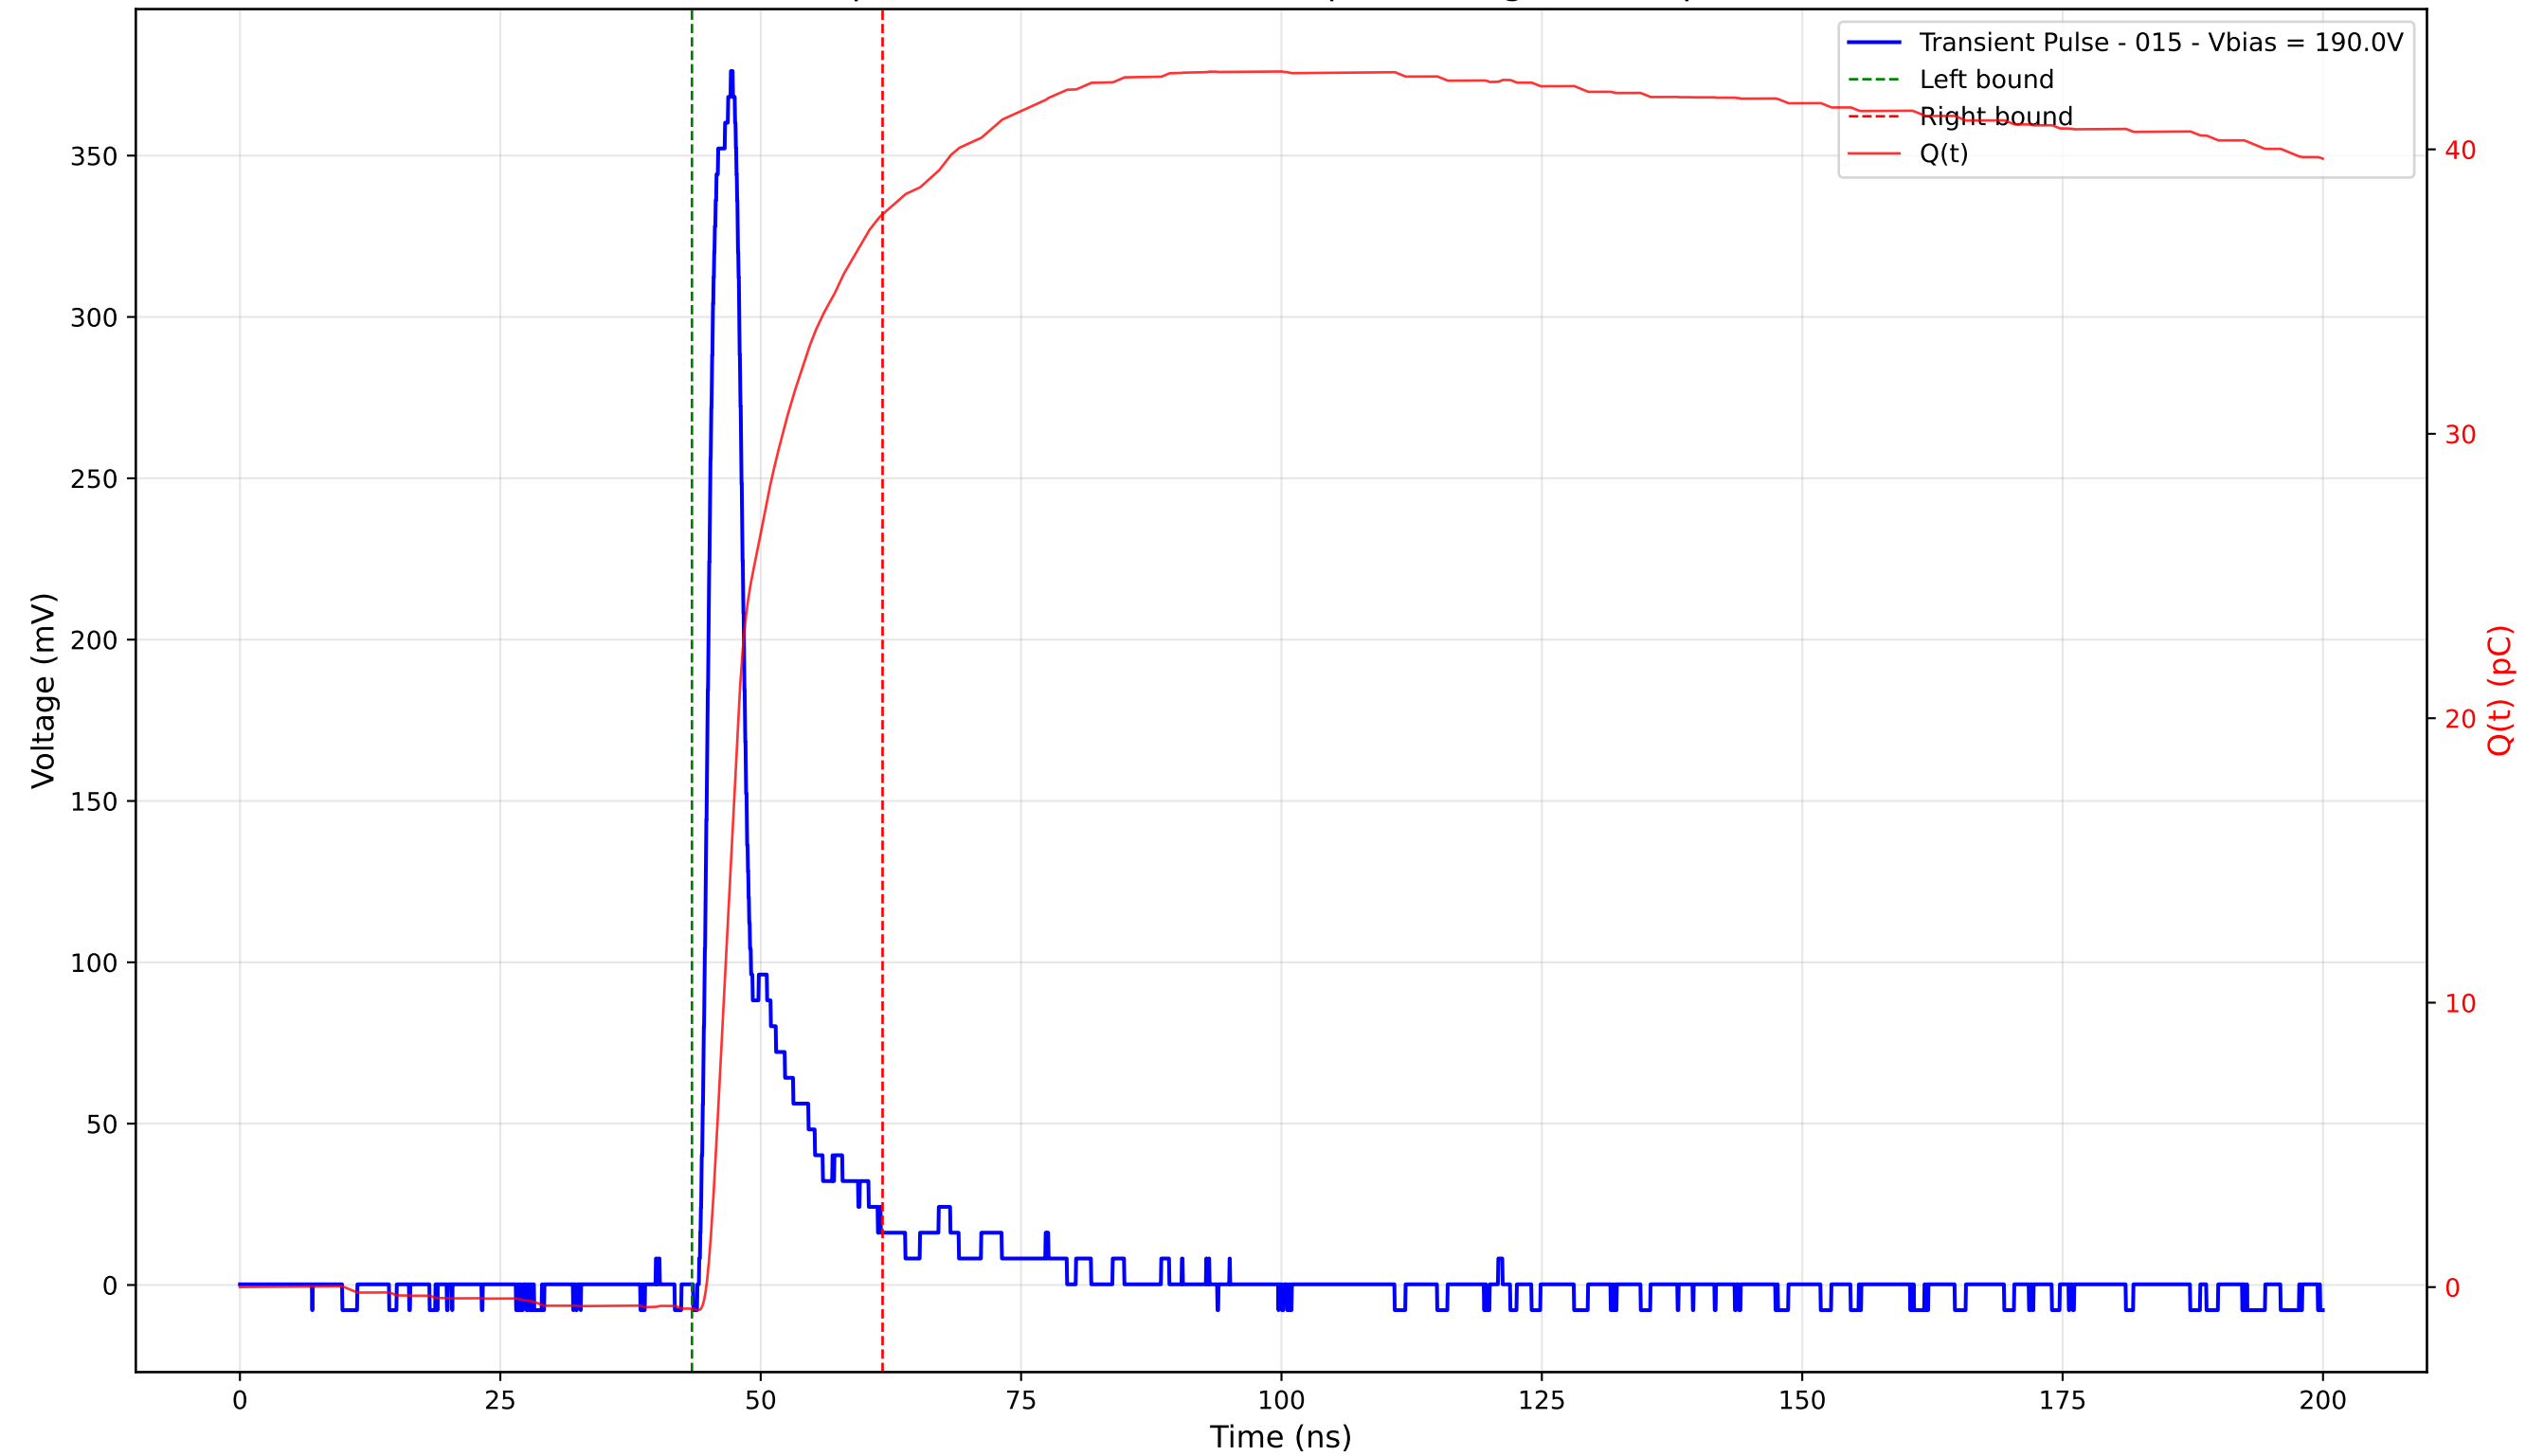


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 38.71 pC - Rise Time: 1.39 ns

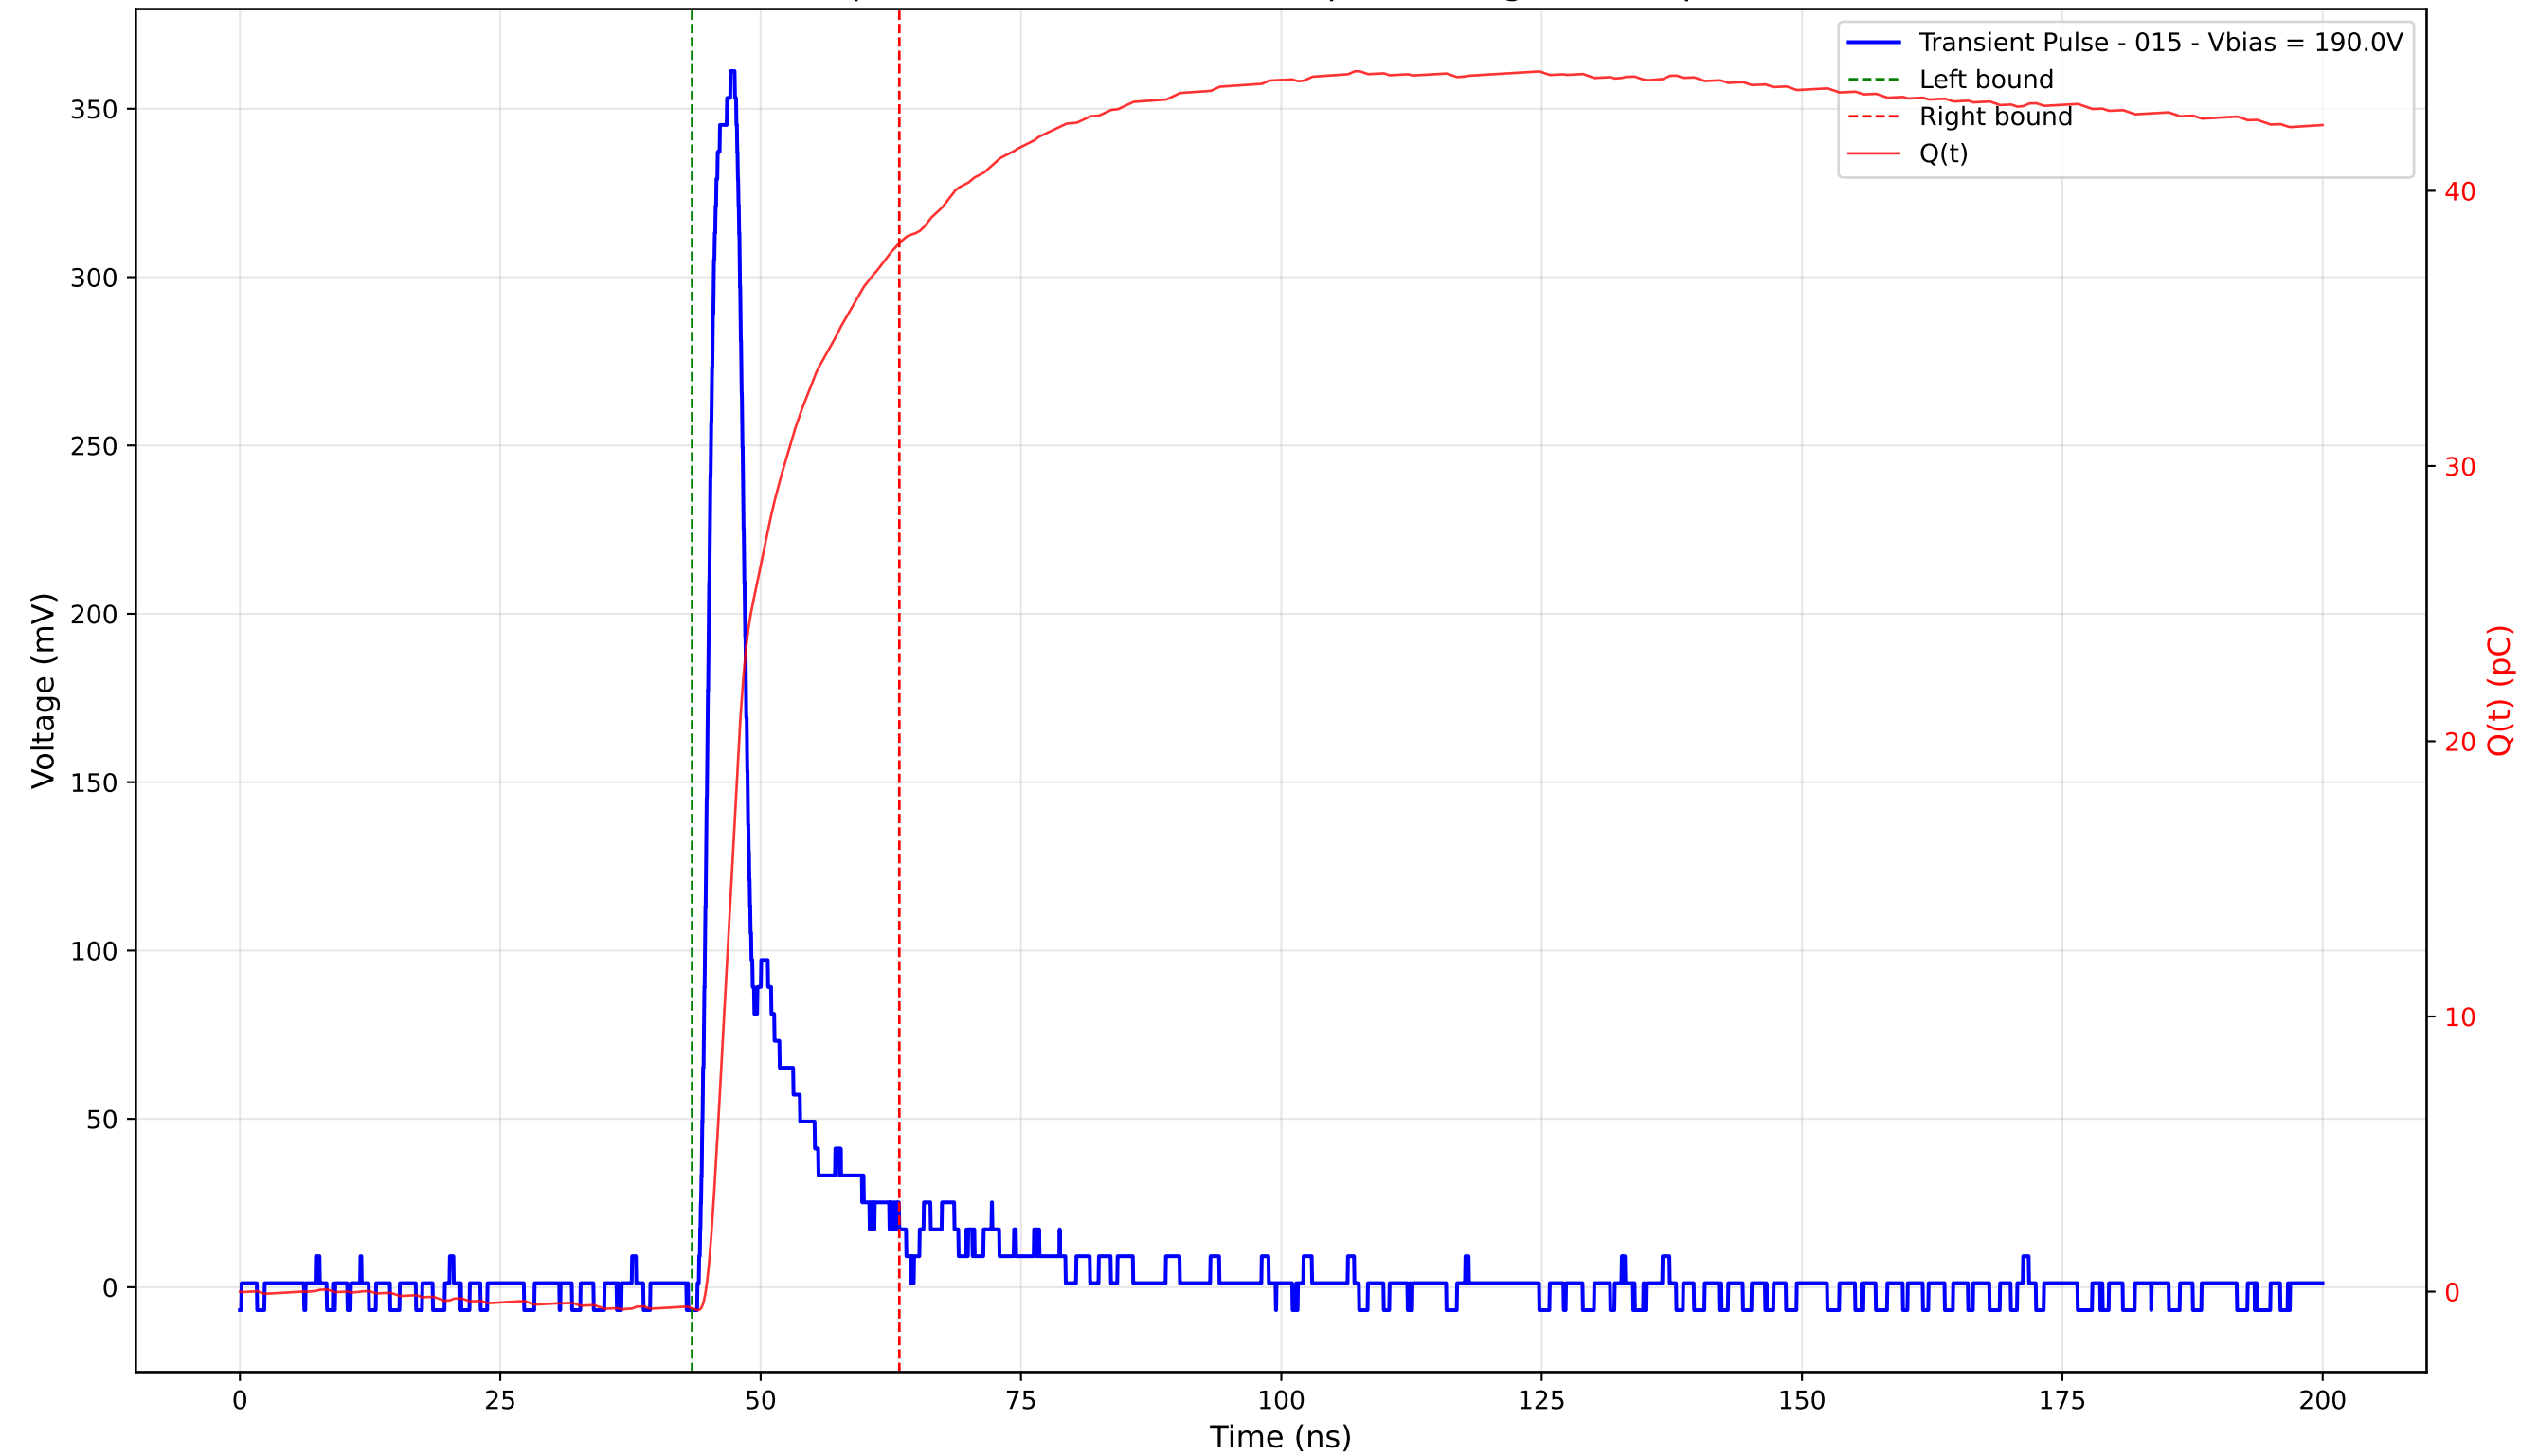


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 37.98 pC - Rise Time: 1.74 ns

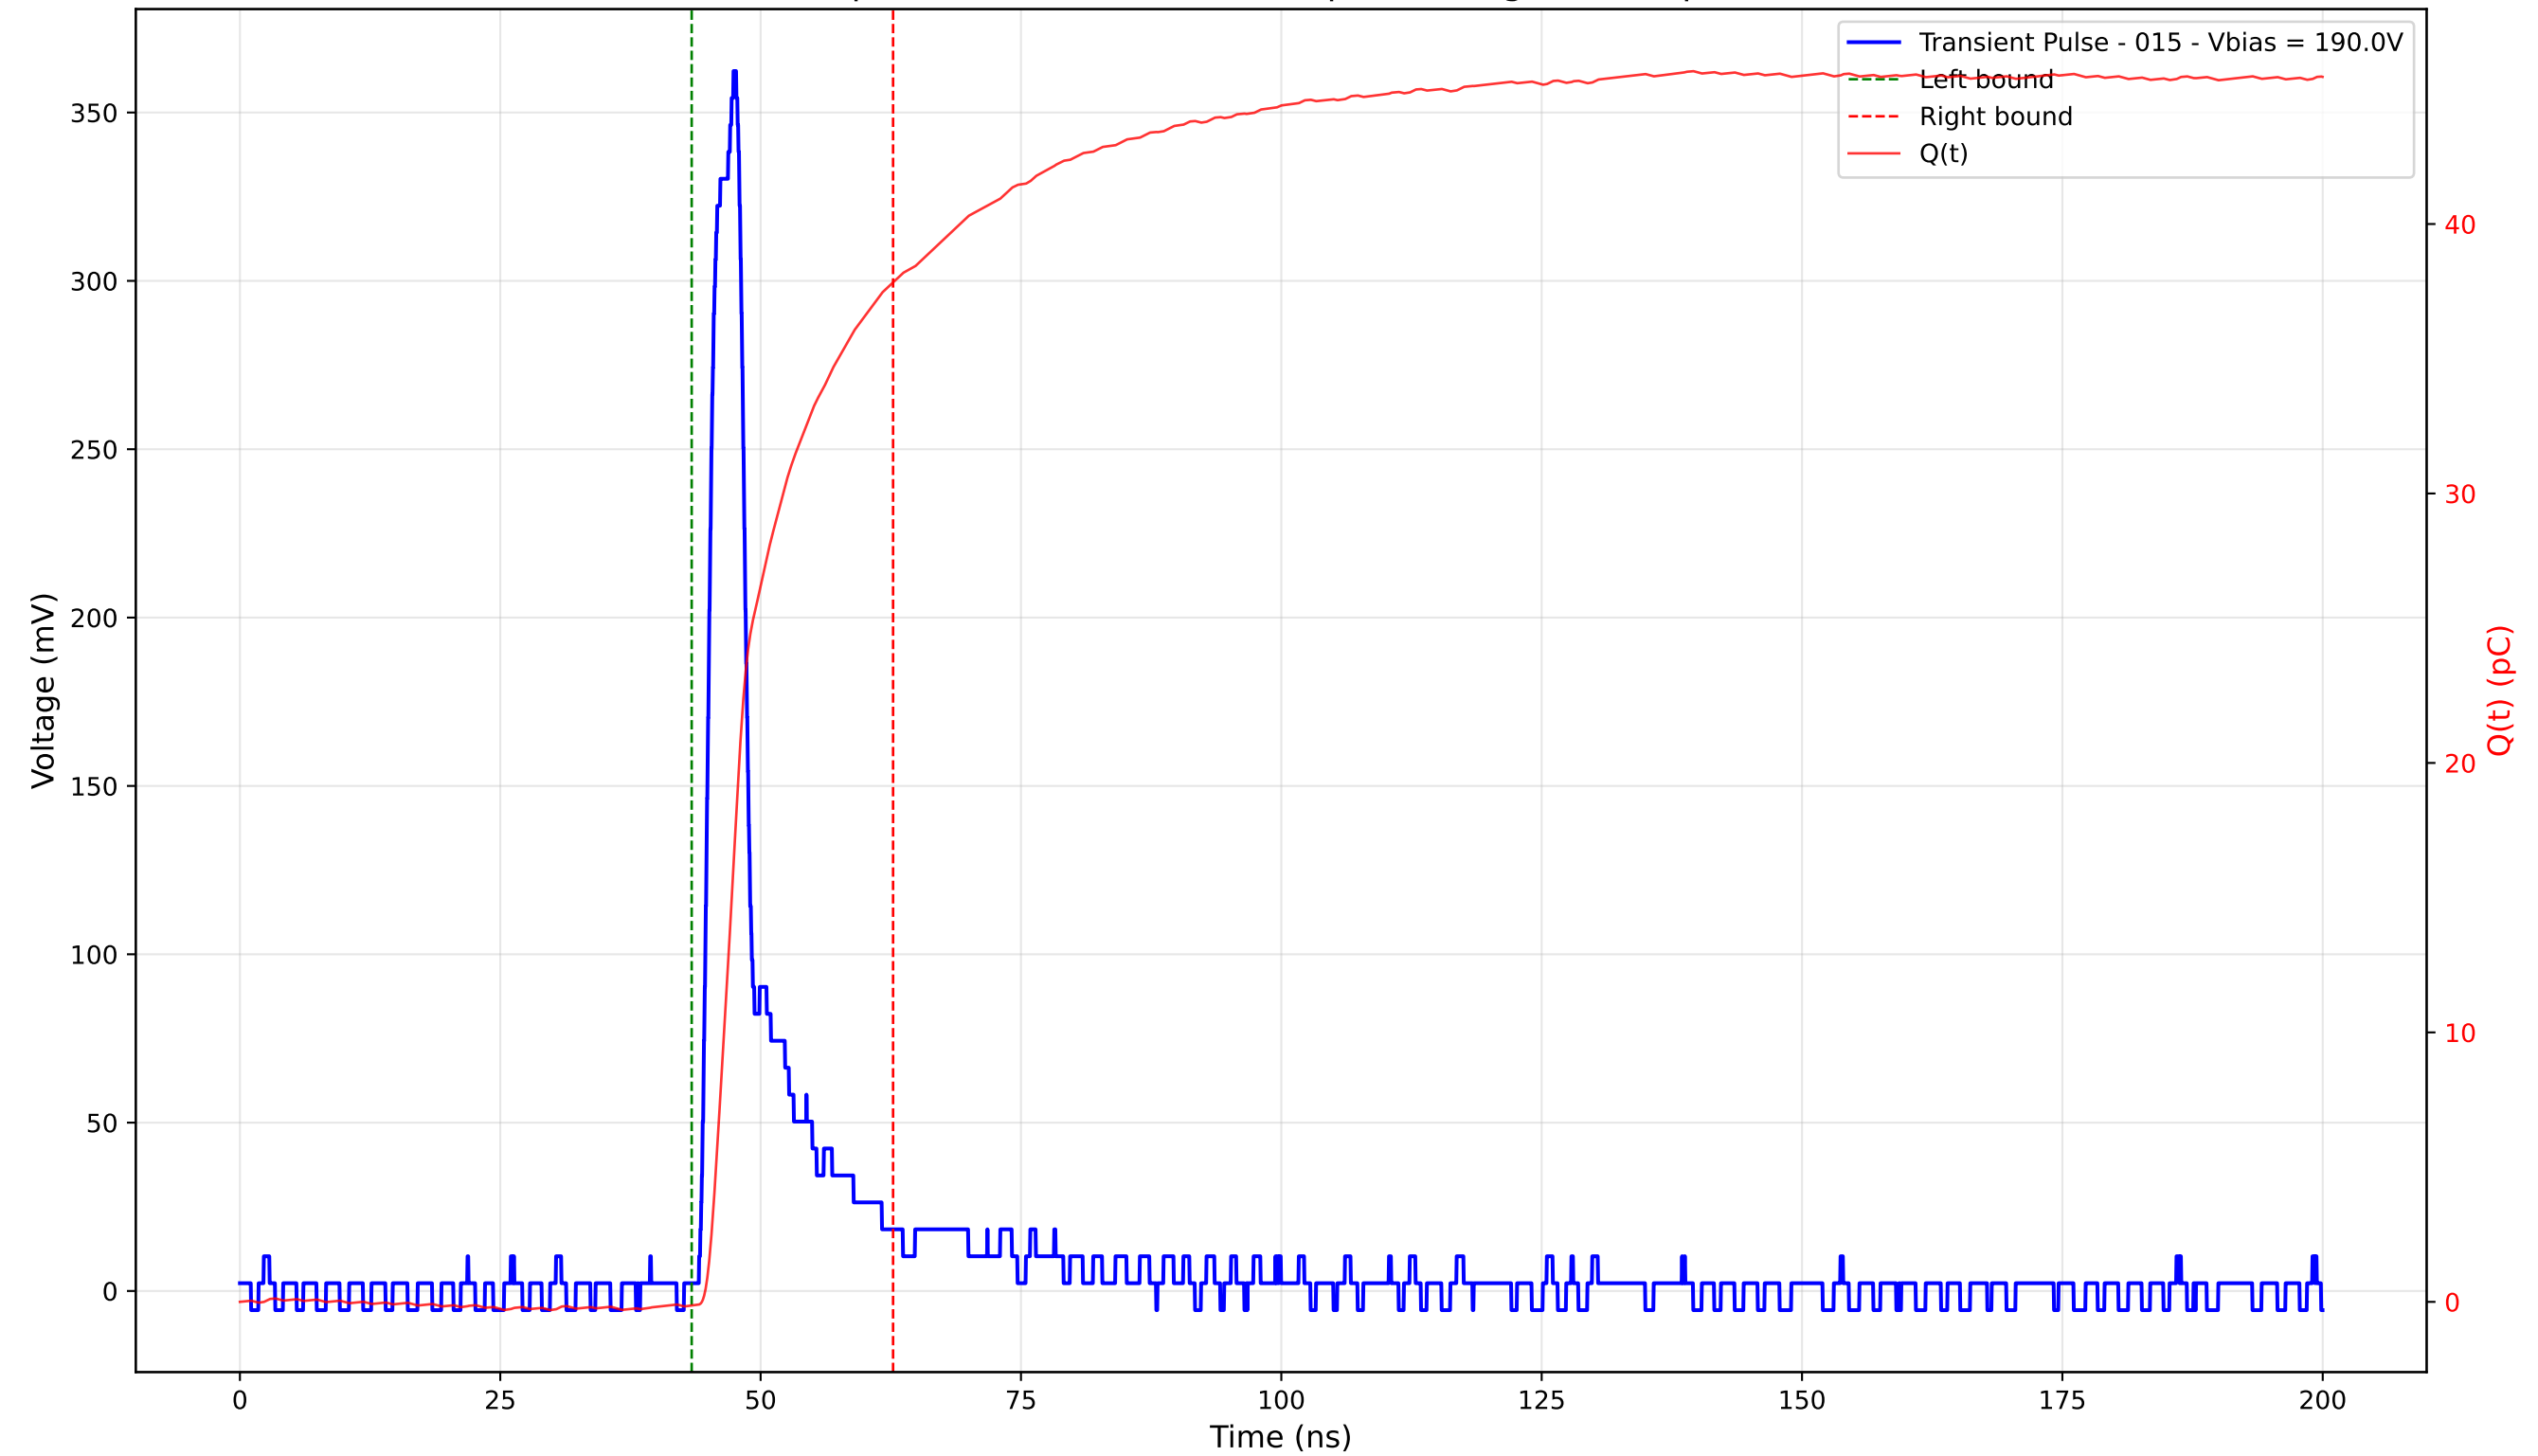


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 37.60 pC - Rise Time: 2.46 ns

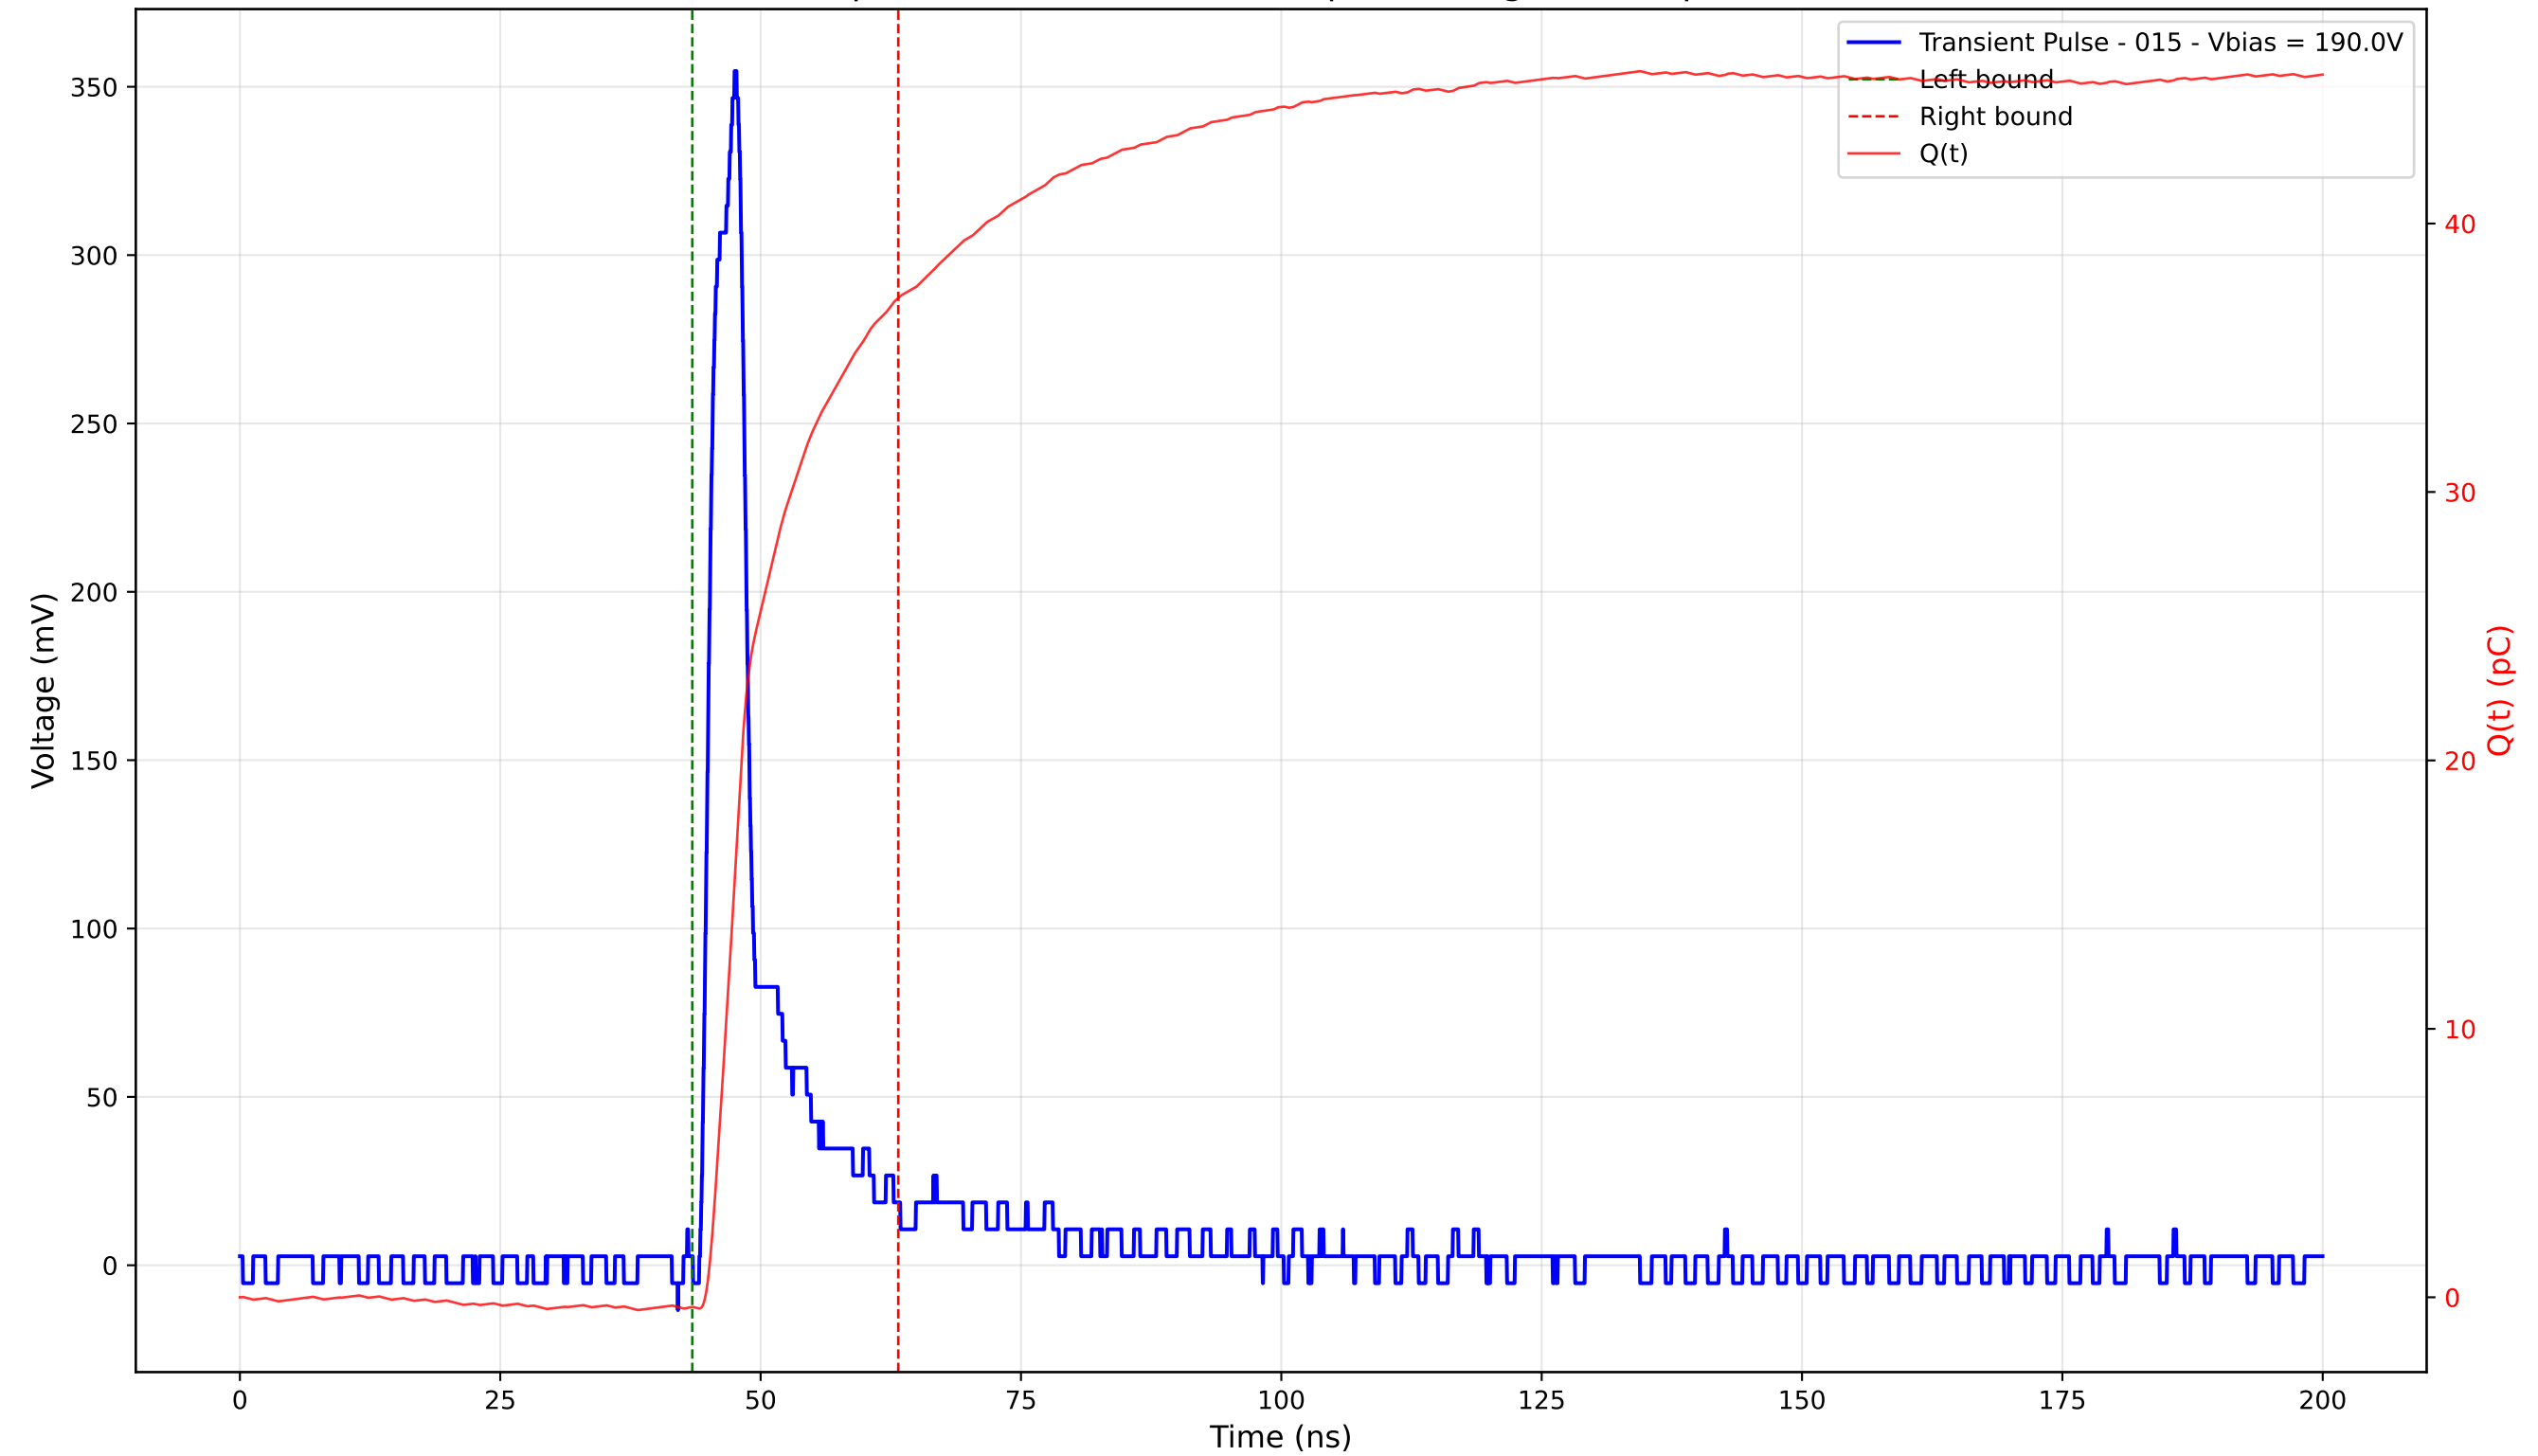


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 37.25 pC - Rise Time: 2.12 ns

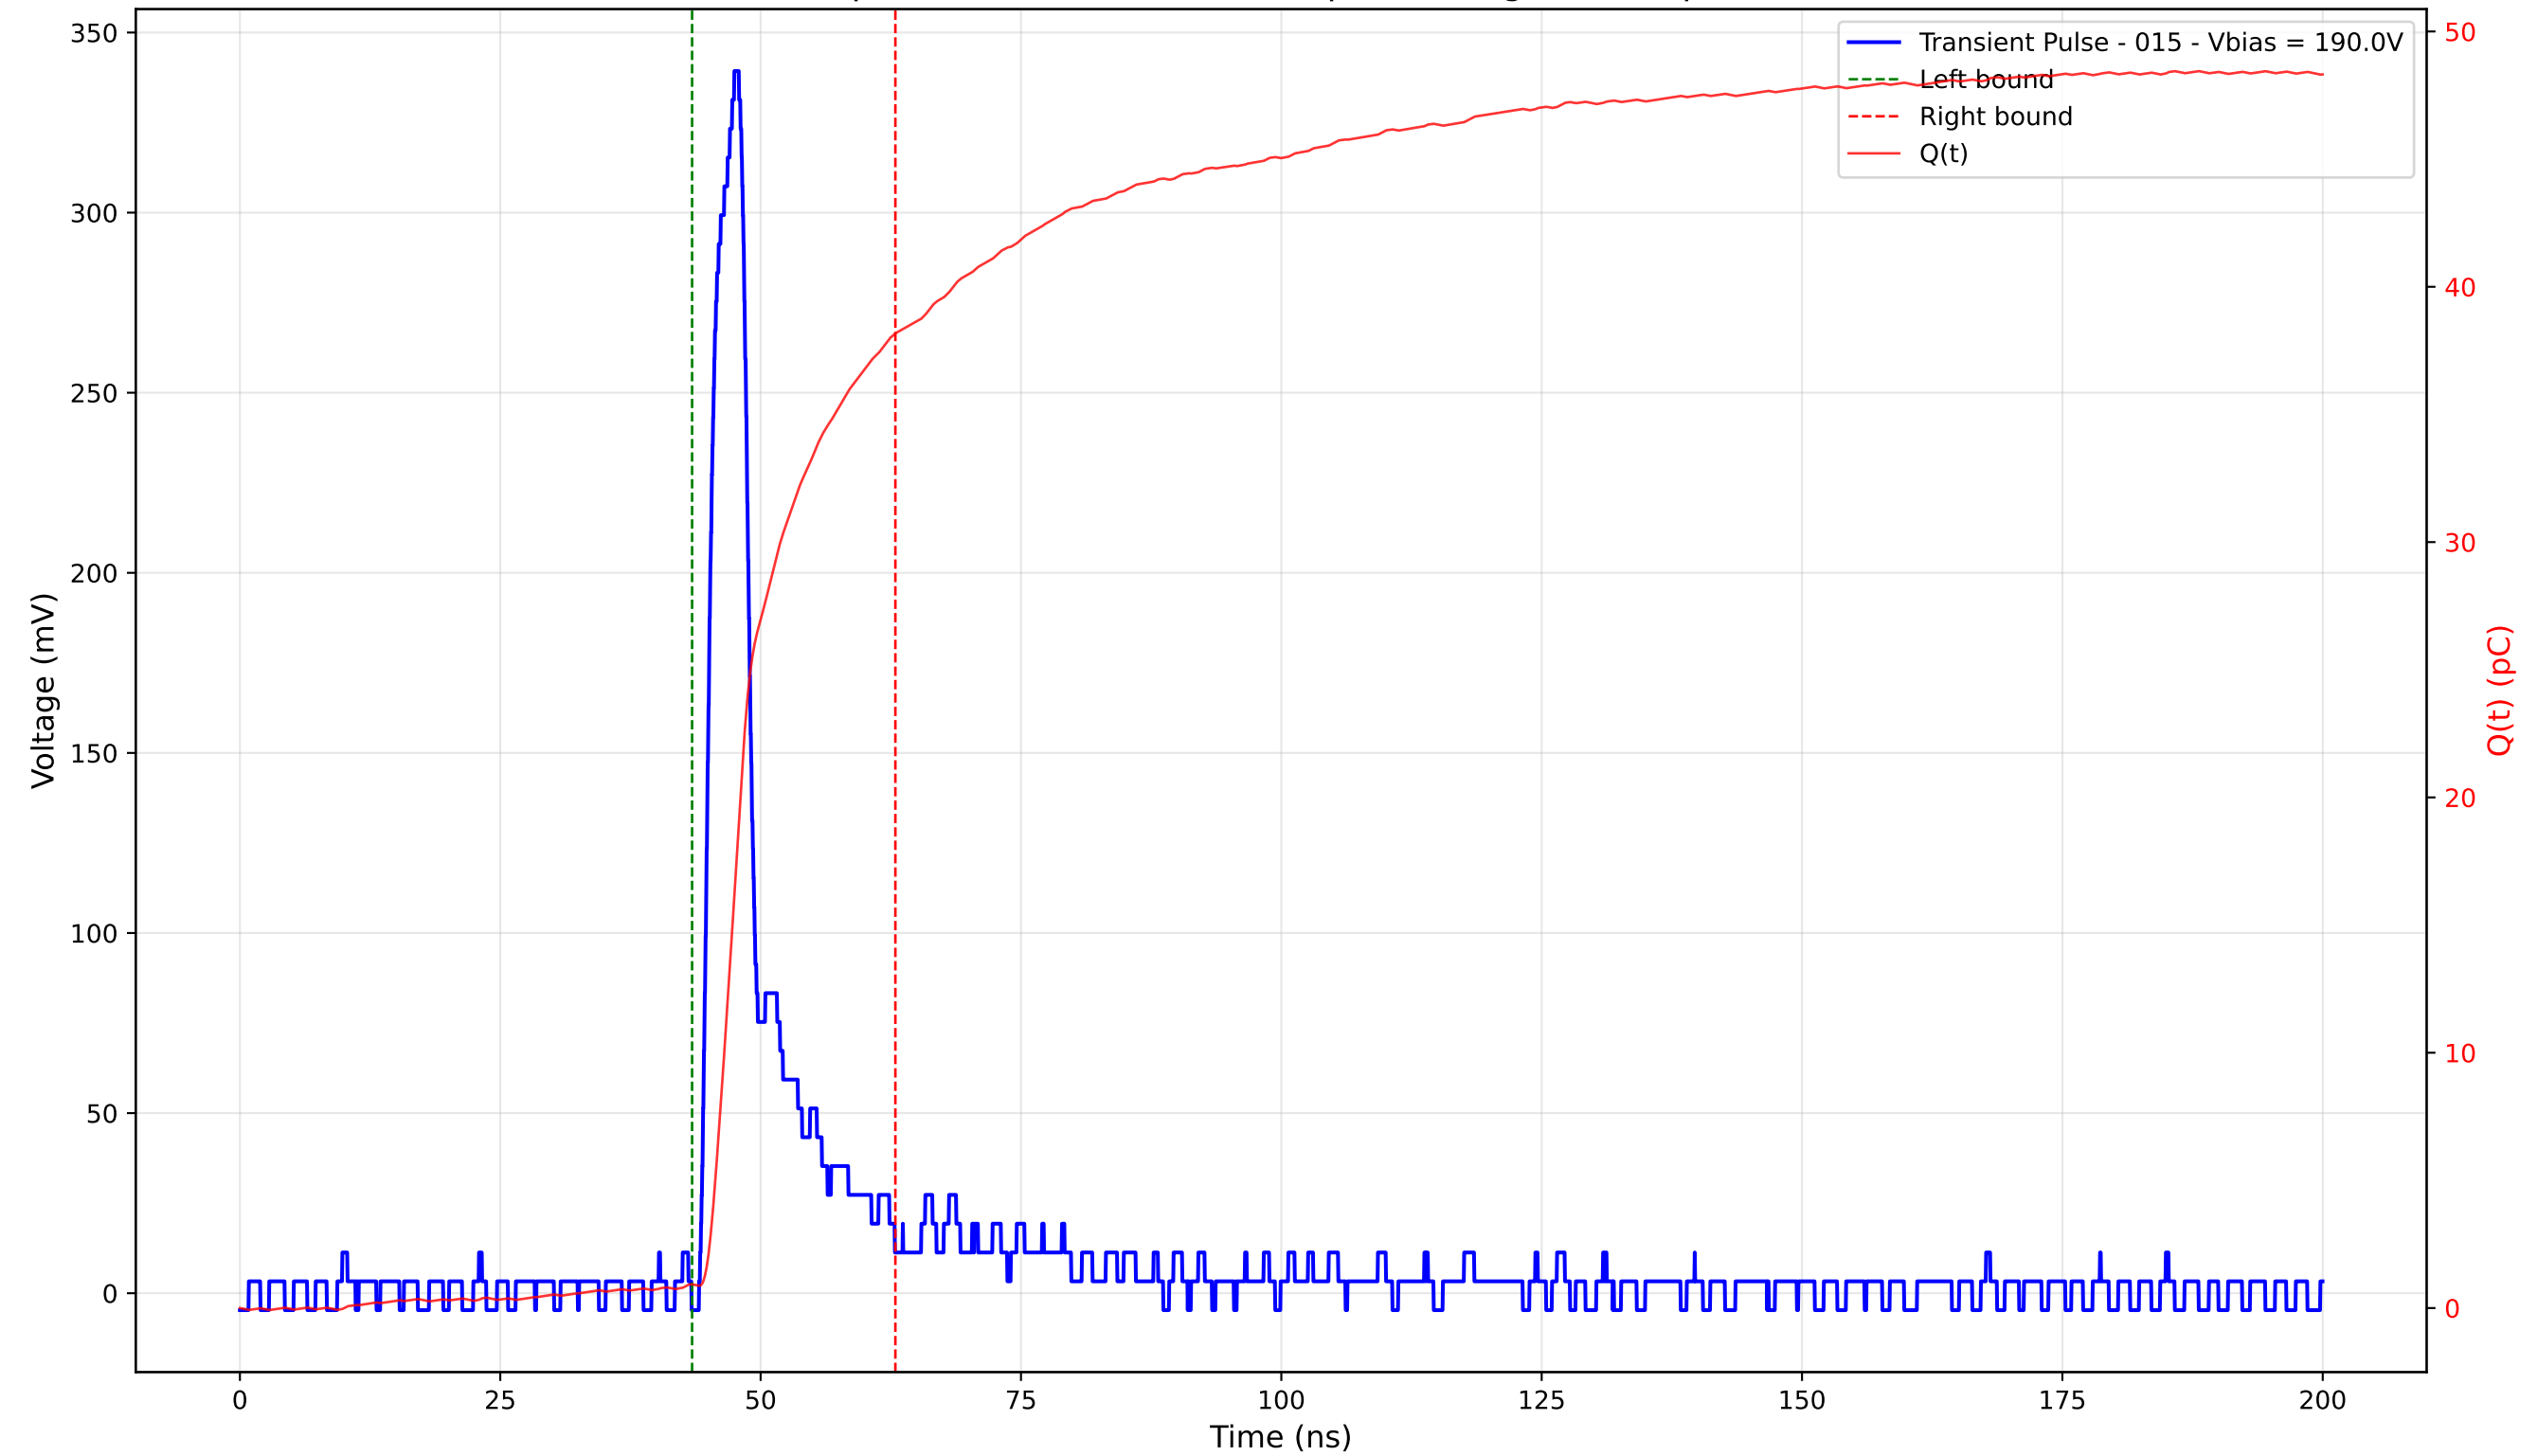


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 34.68 pC - Rise Time: 2.54 ns

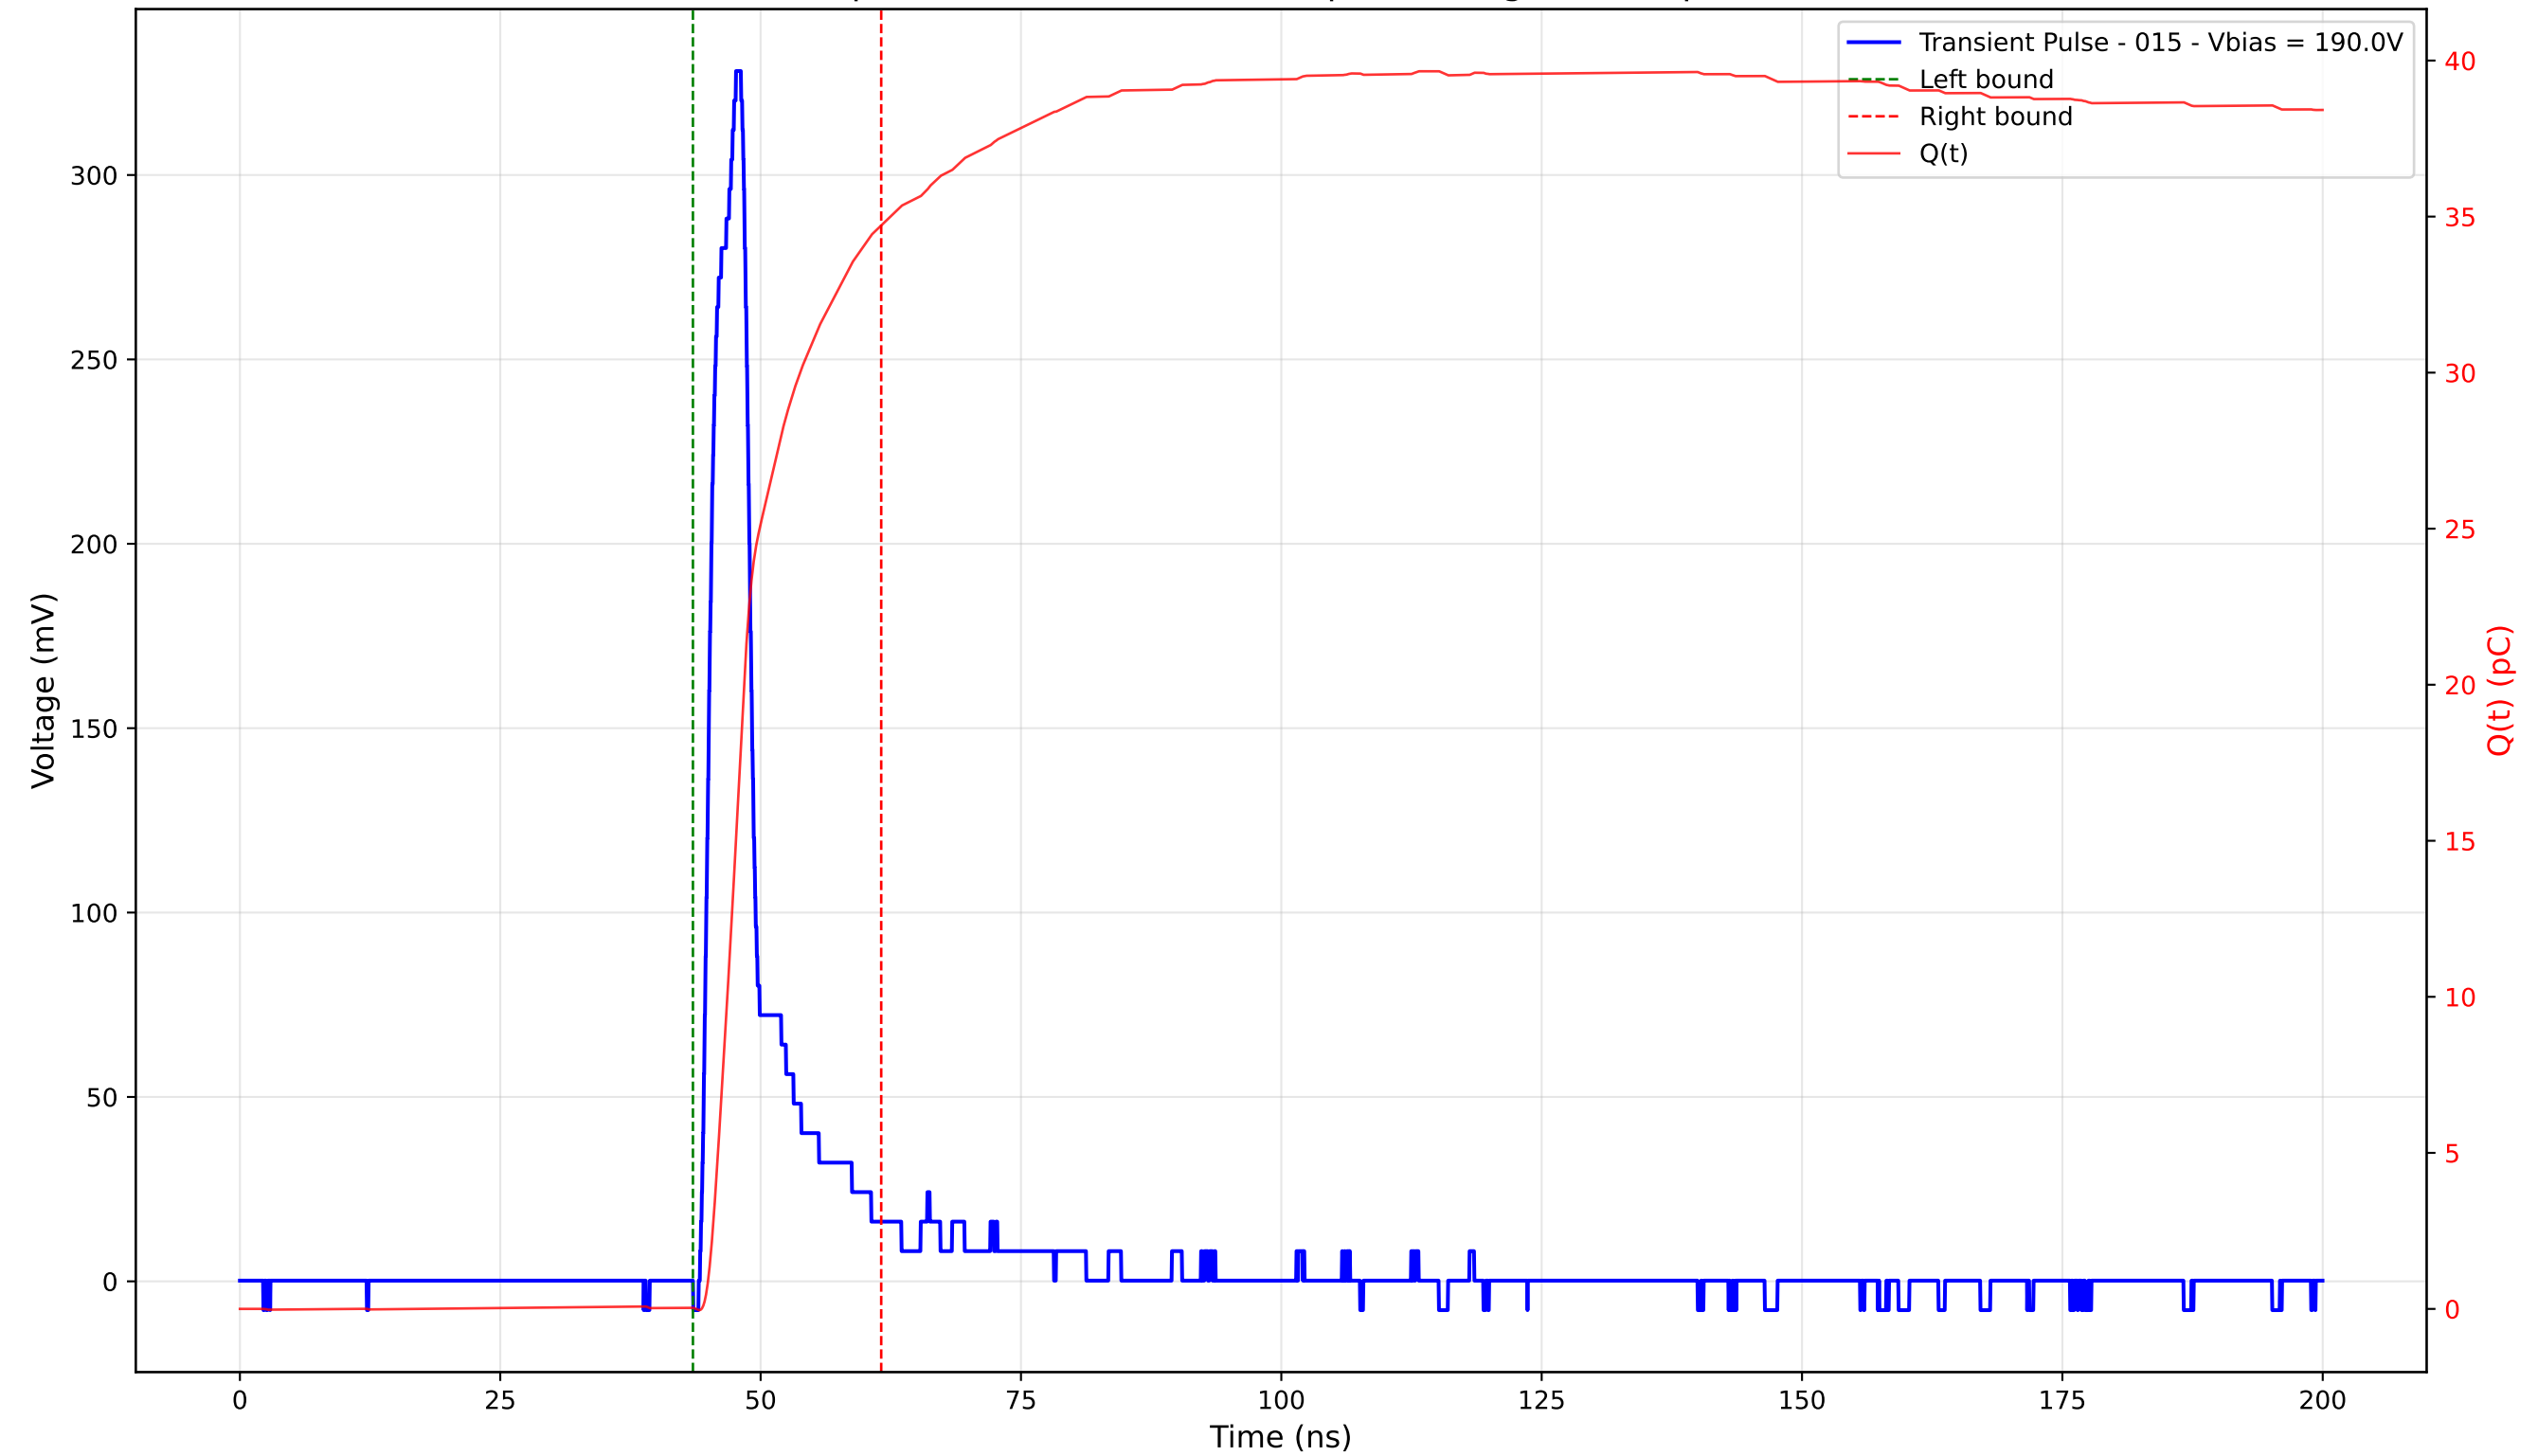


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 35.59 pC - Rise Time: 2.82 ns

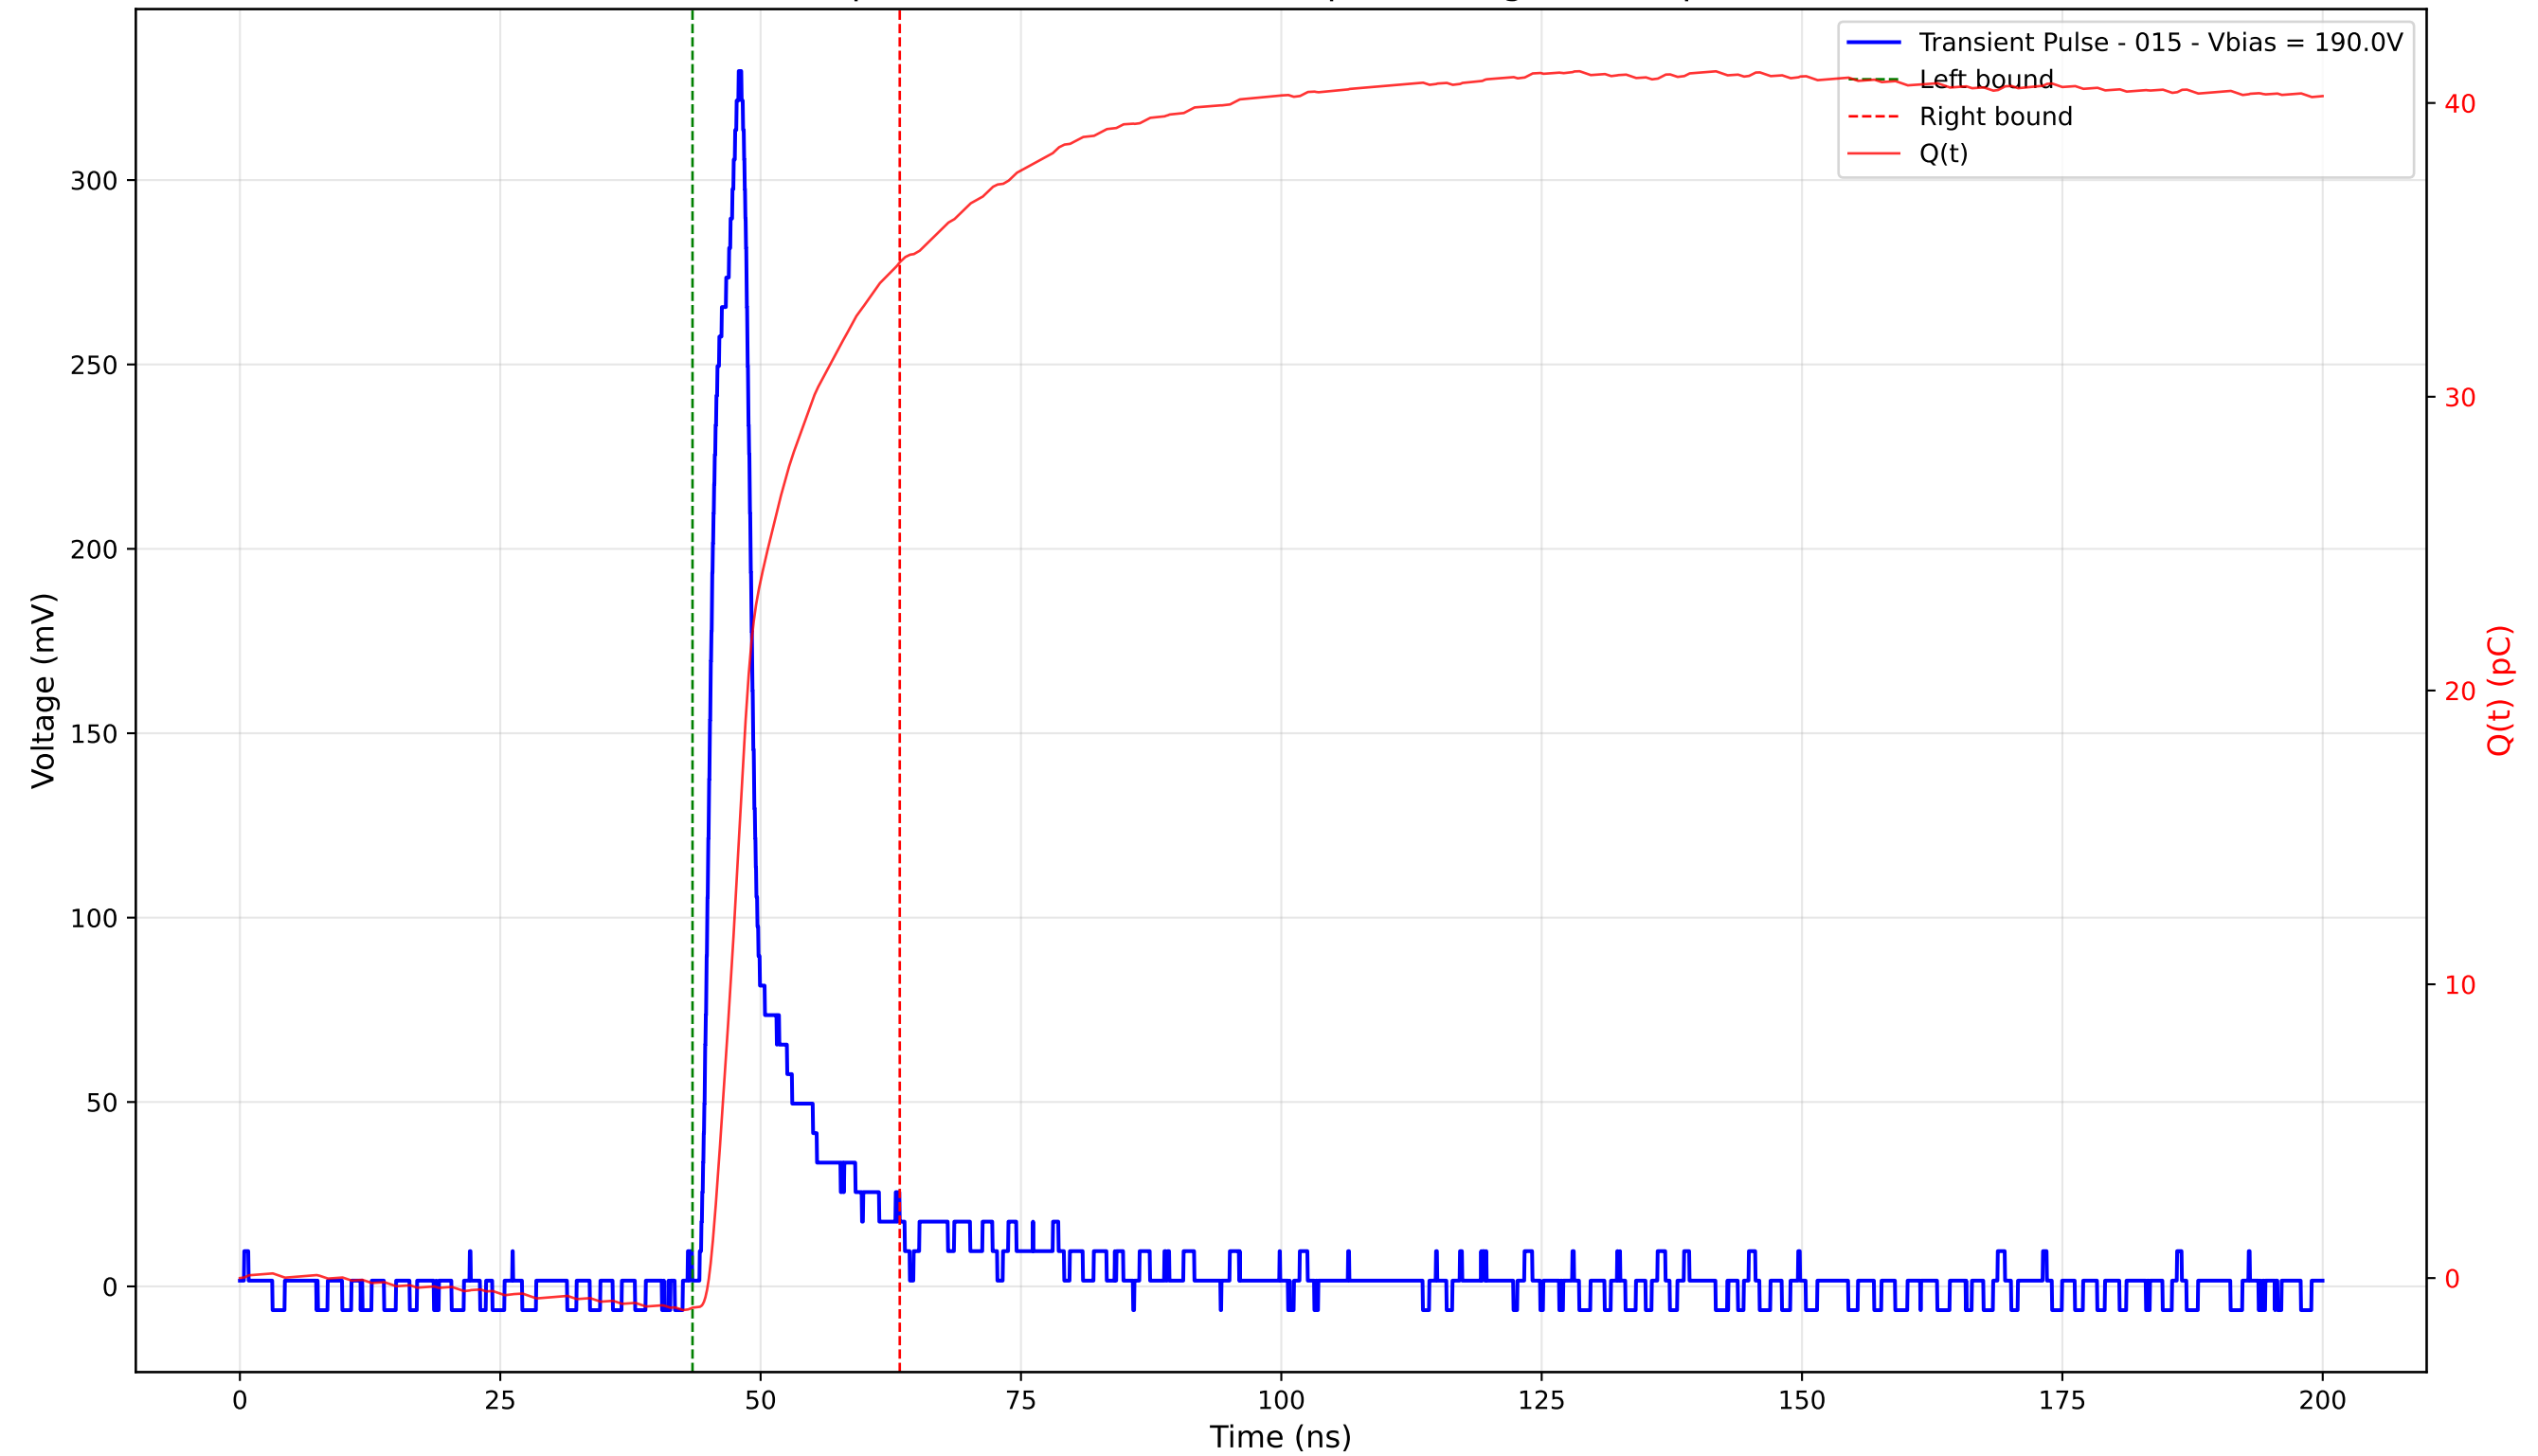


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 35.40 pC - Rise Time: 3.05 ns

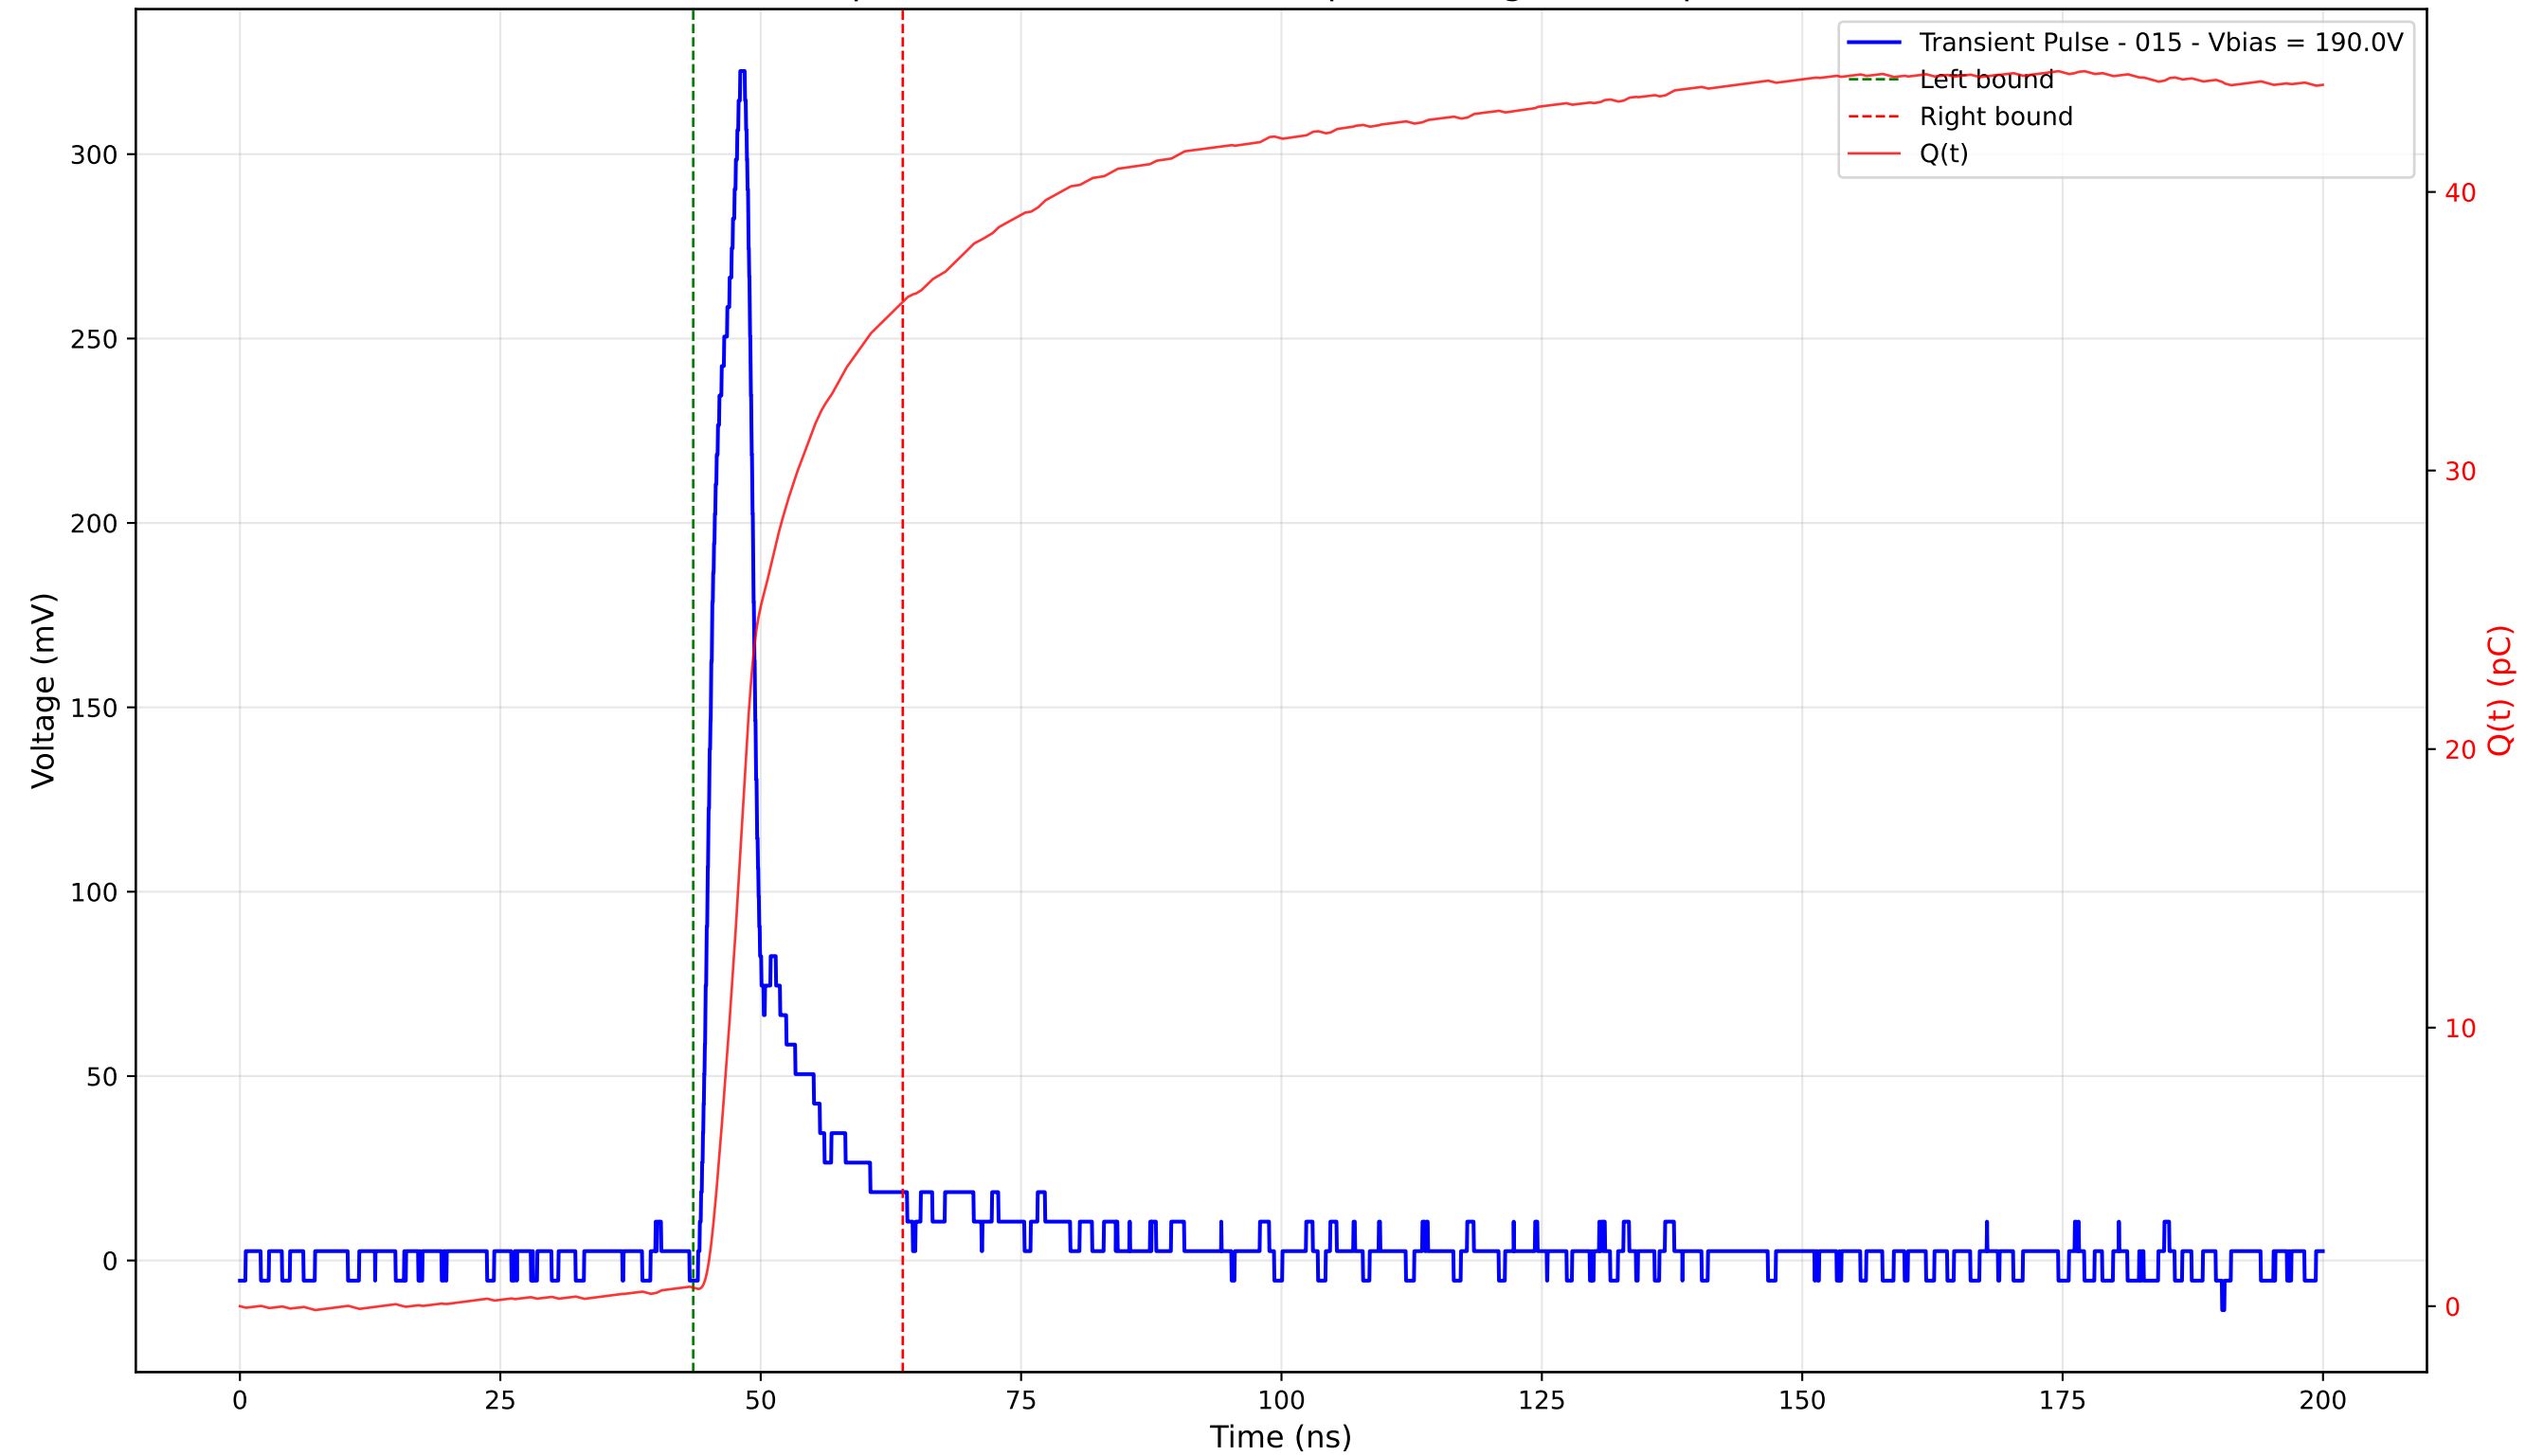


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 33.94 pC - Rise Time: 3.25 ns

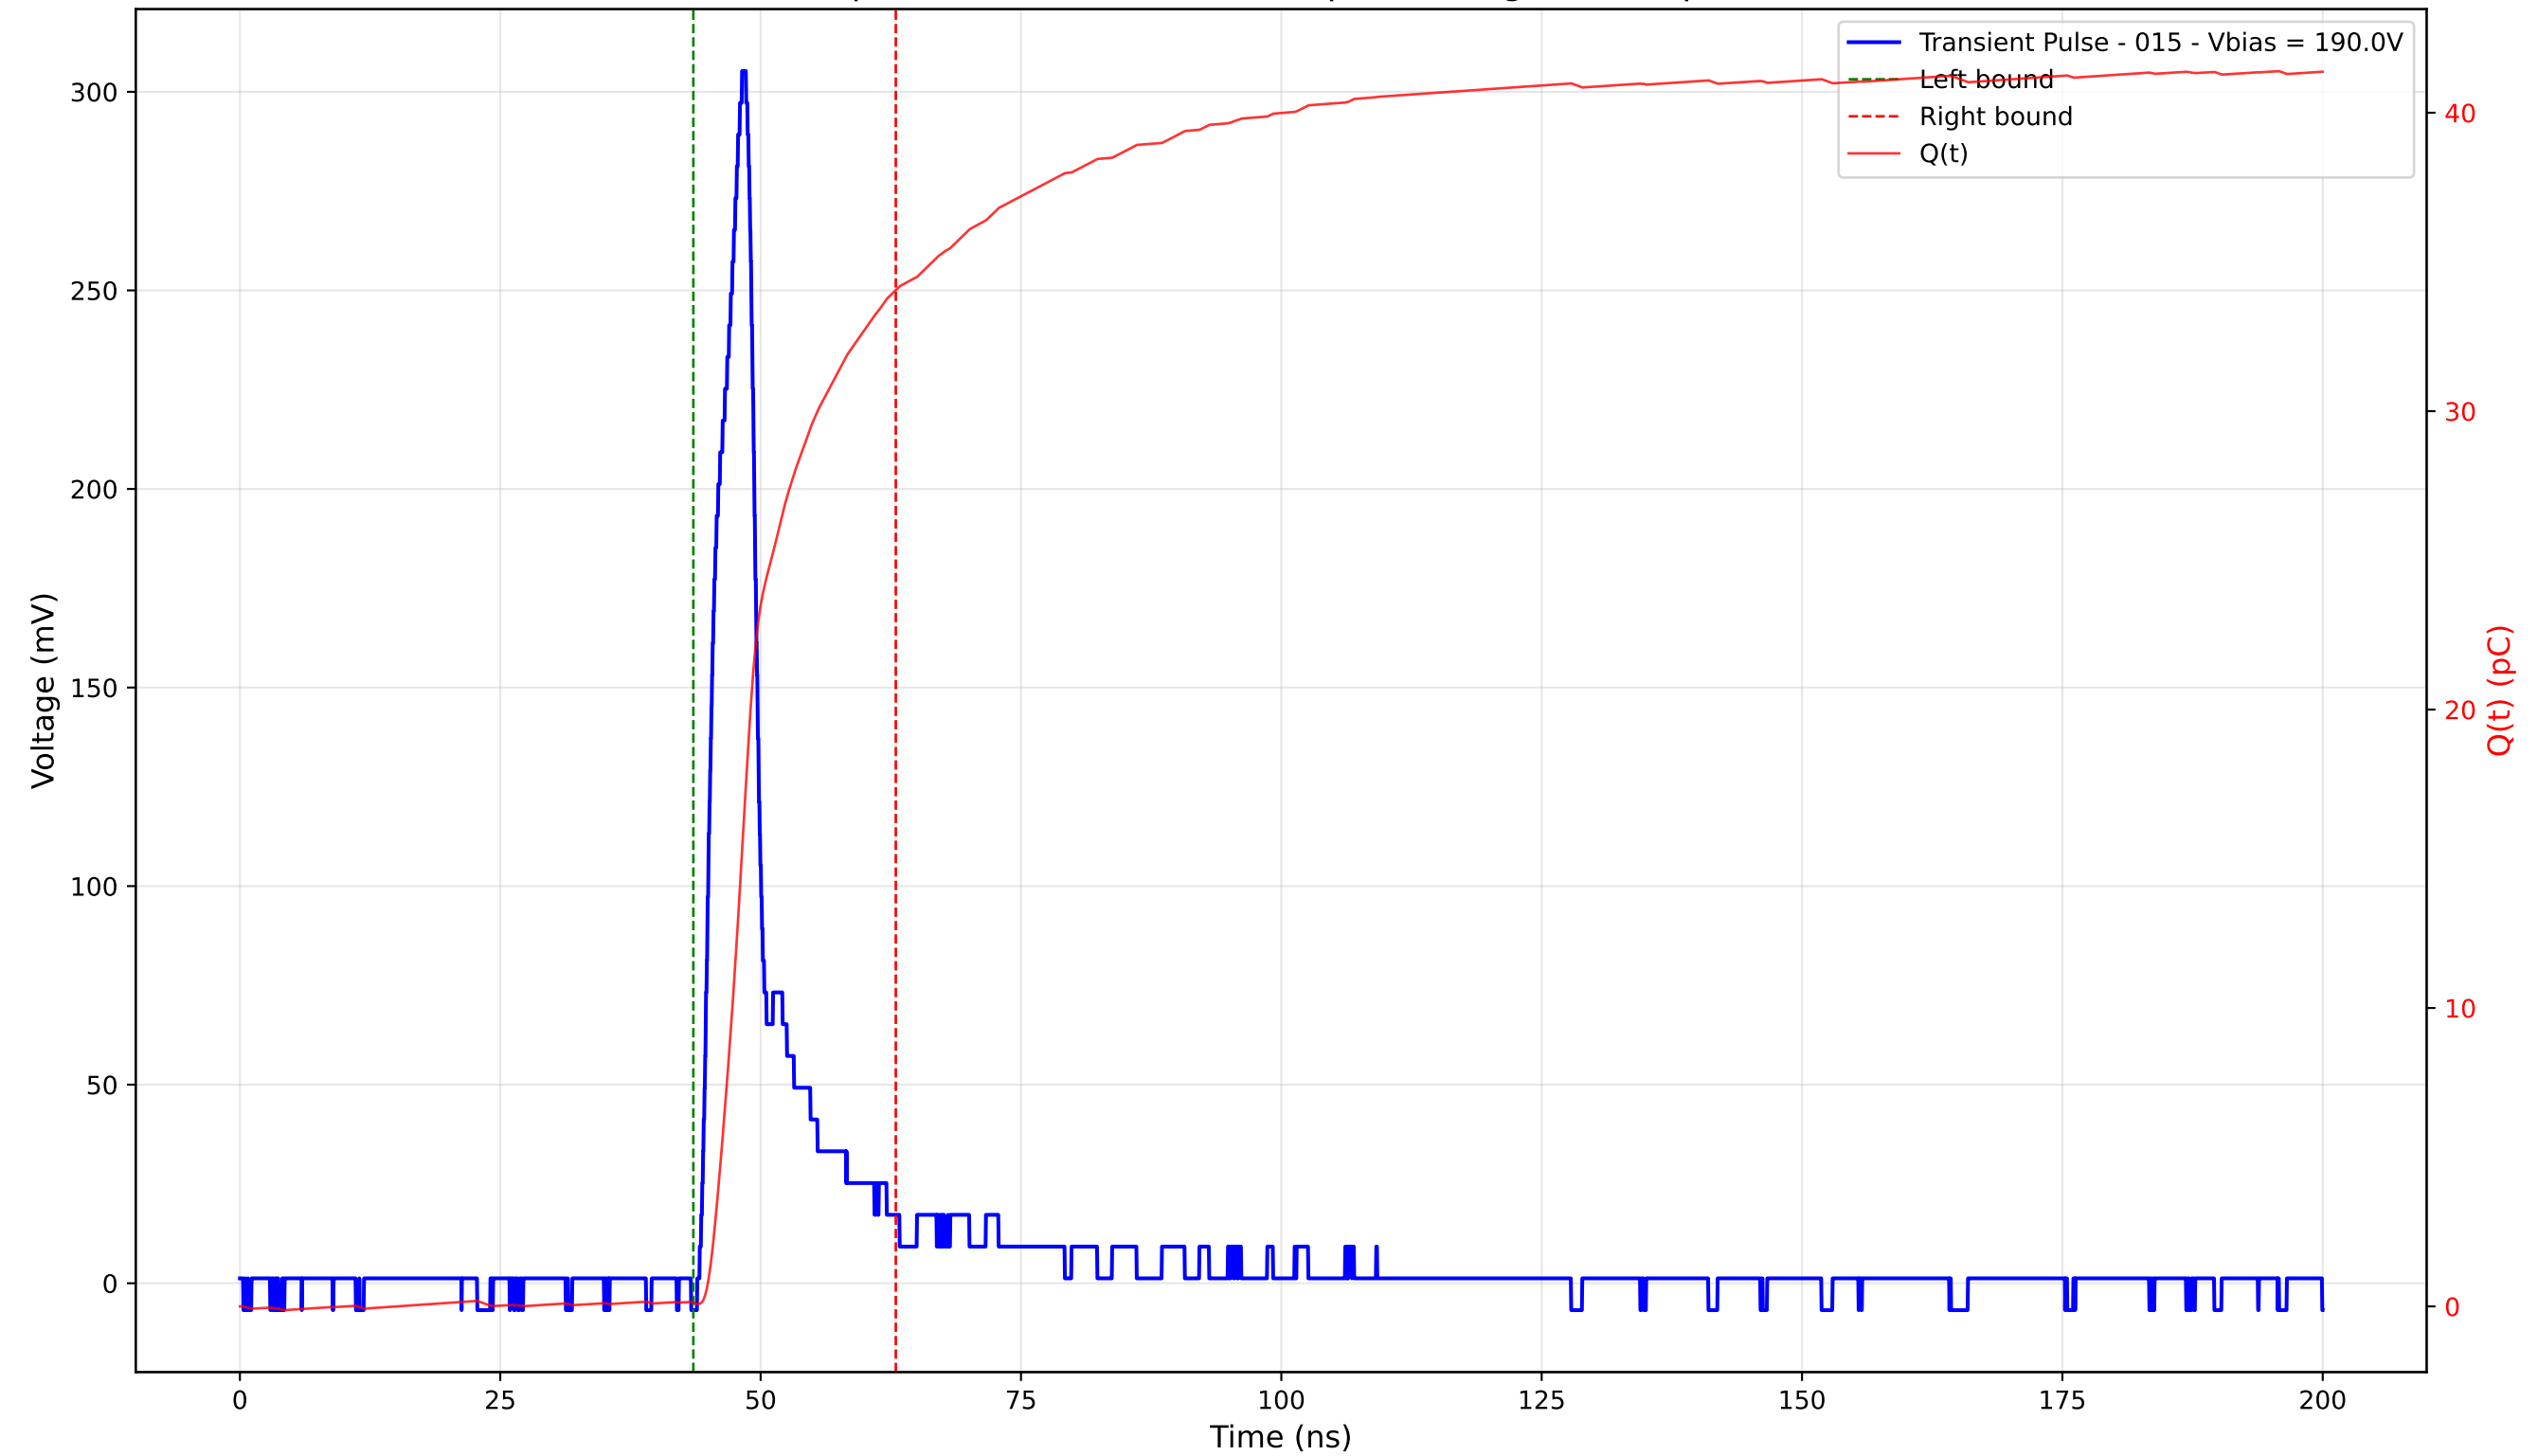


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 33.77 pC - Rise Time: 3.30 ns

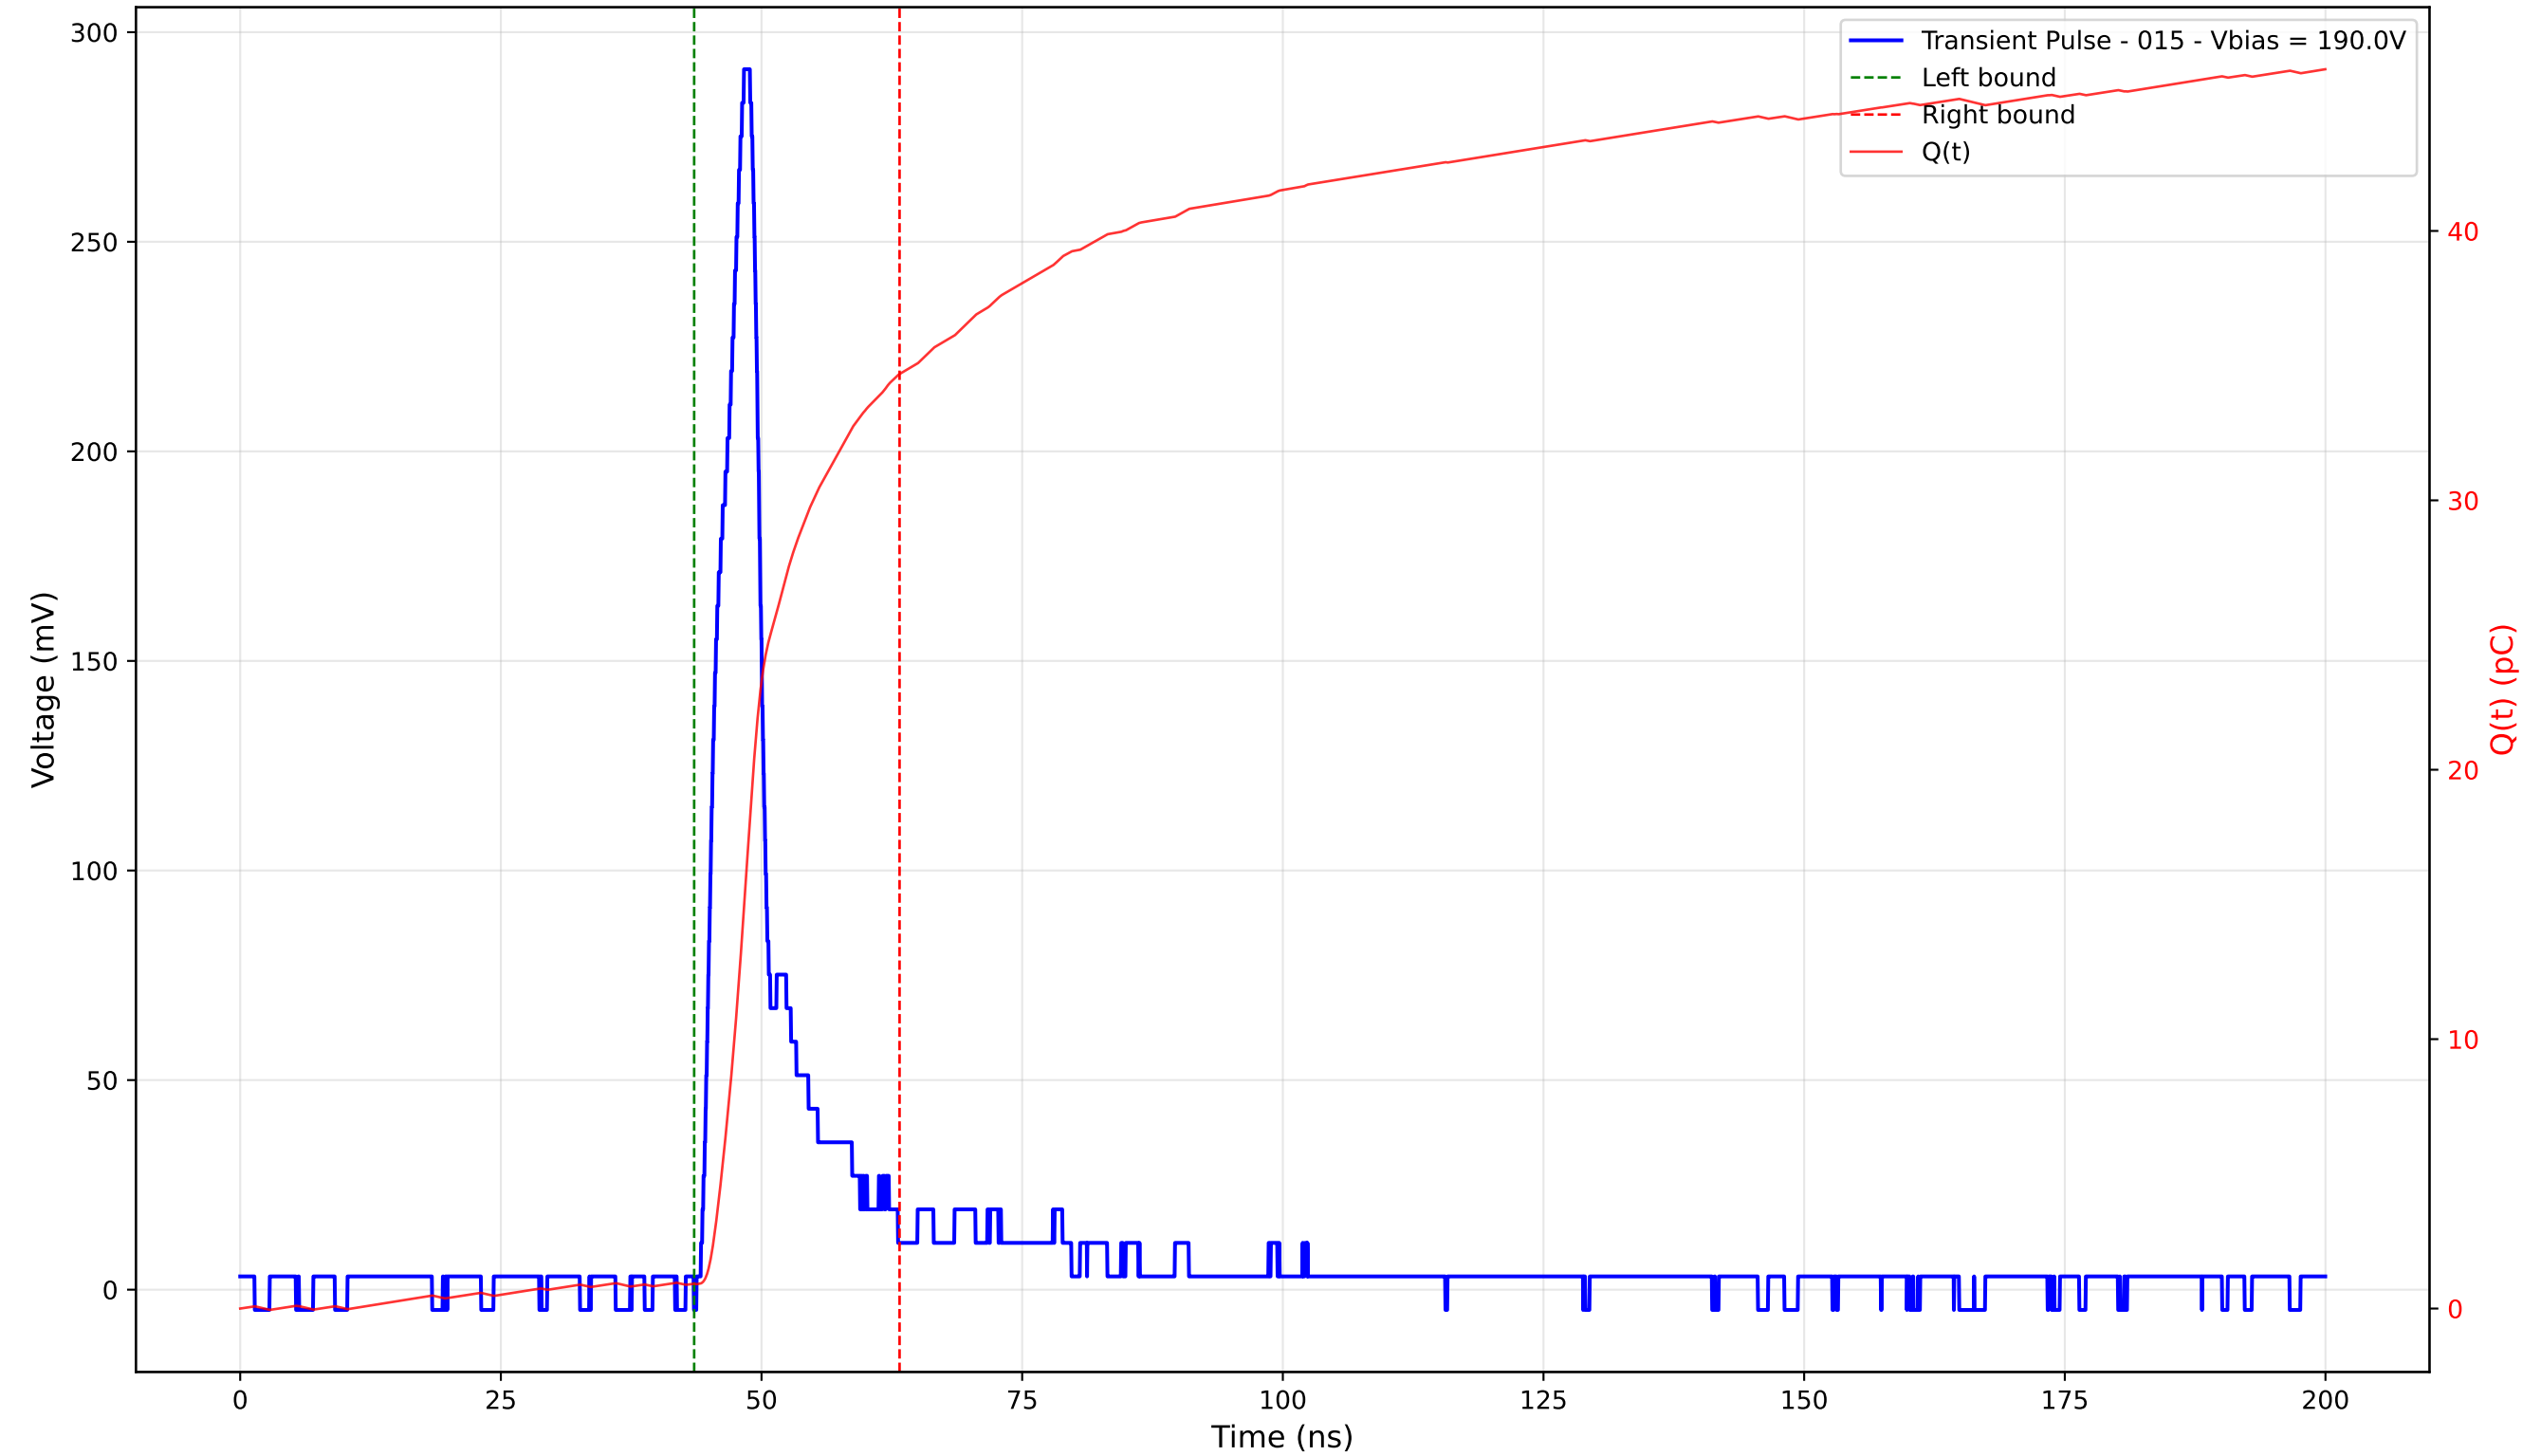


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 31.00 pC - Rise Time: 3.46 ns

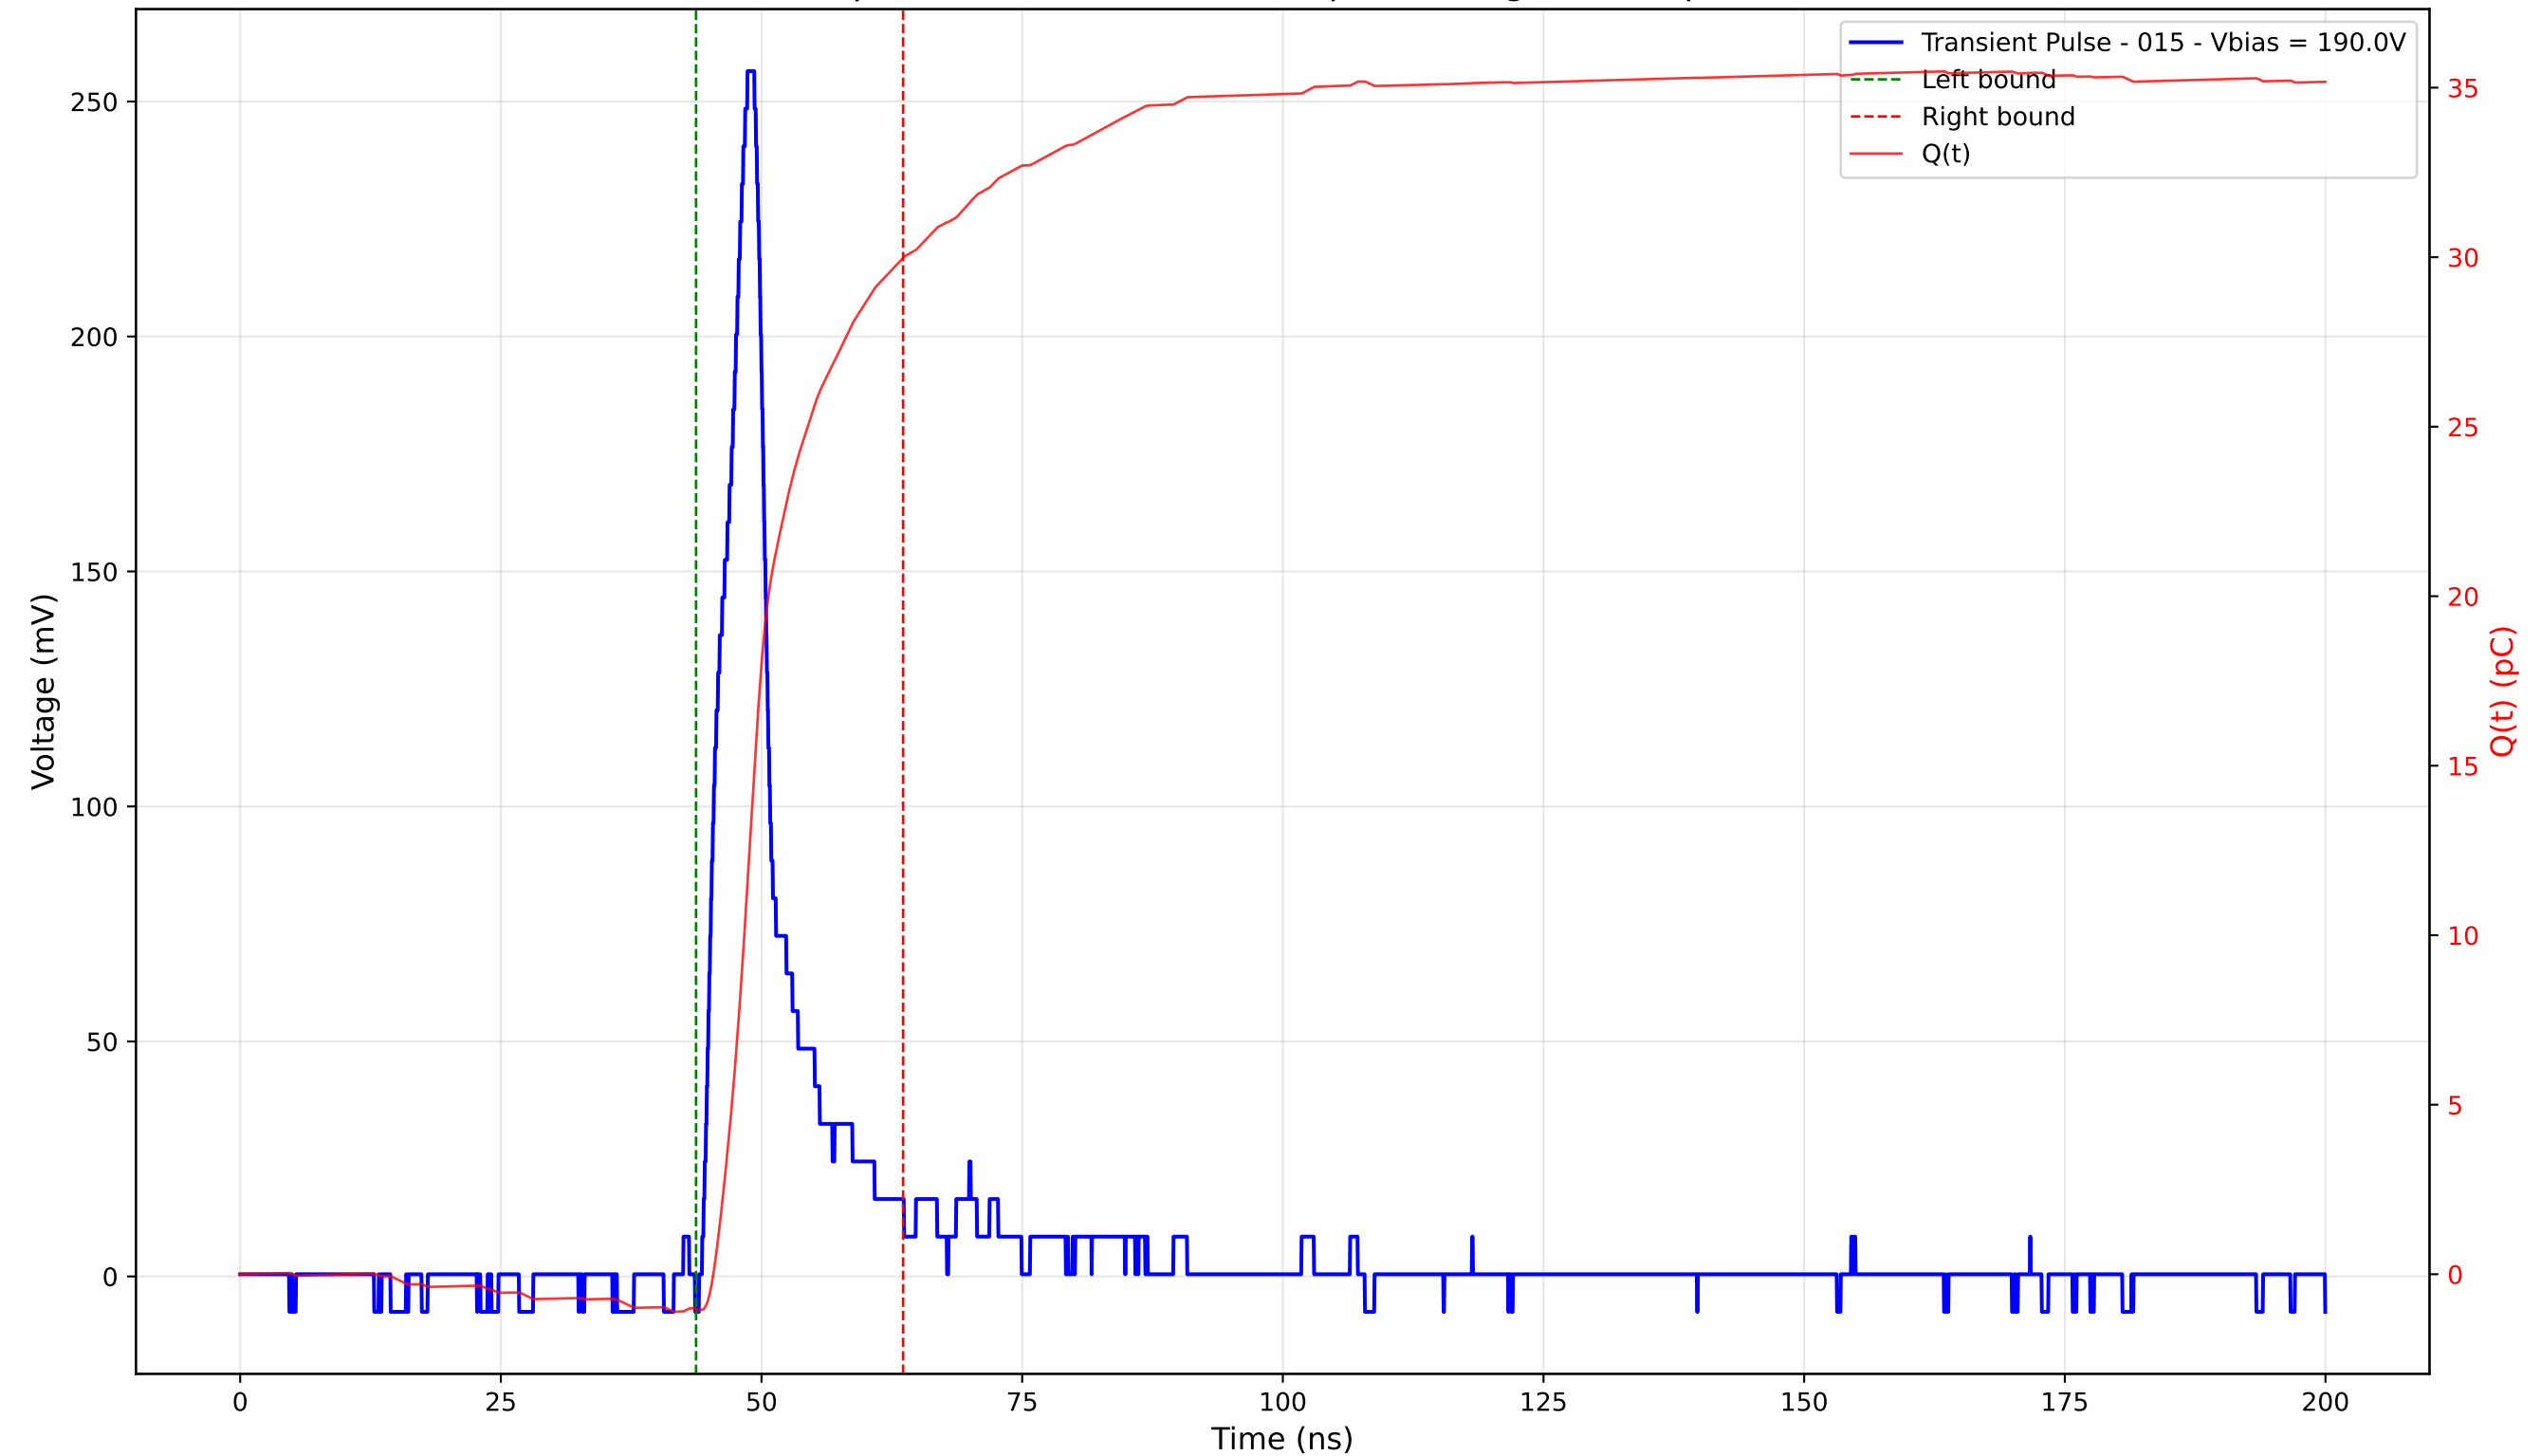


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 31.10 pC - Rise Time: 3.89 ns

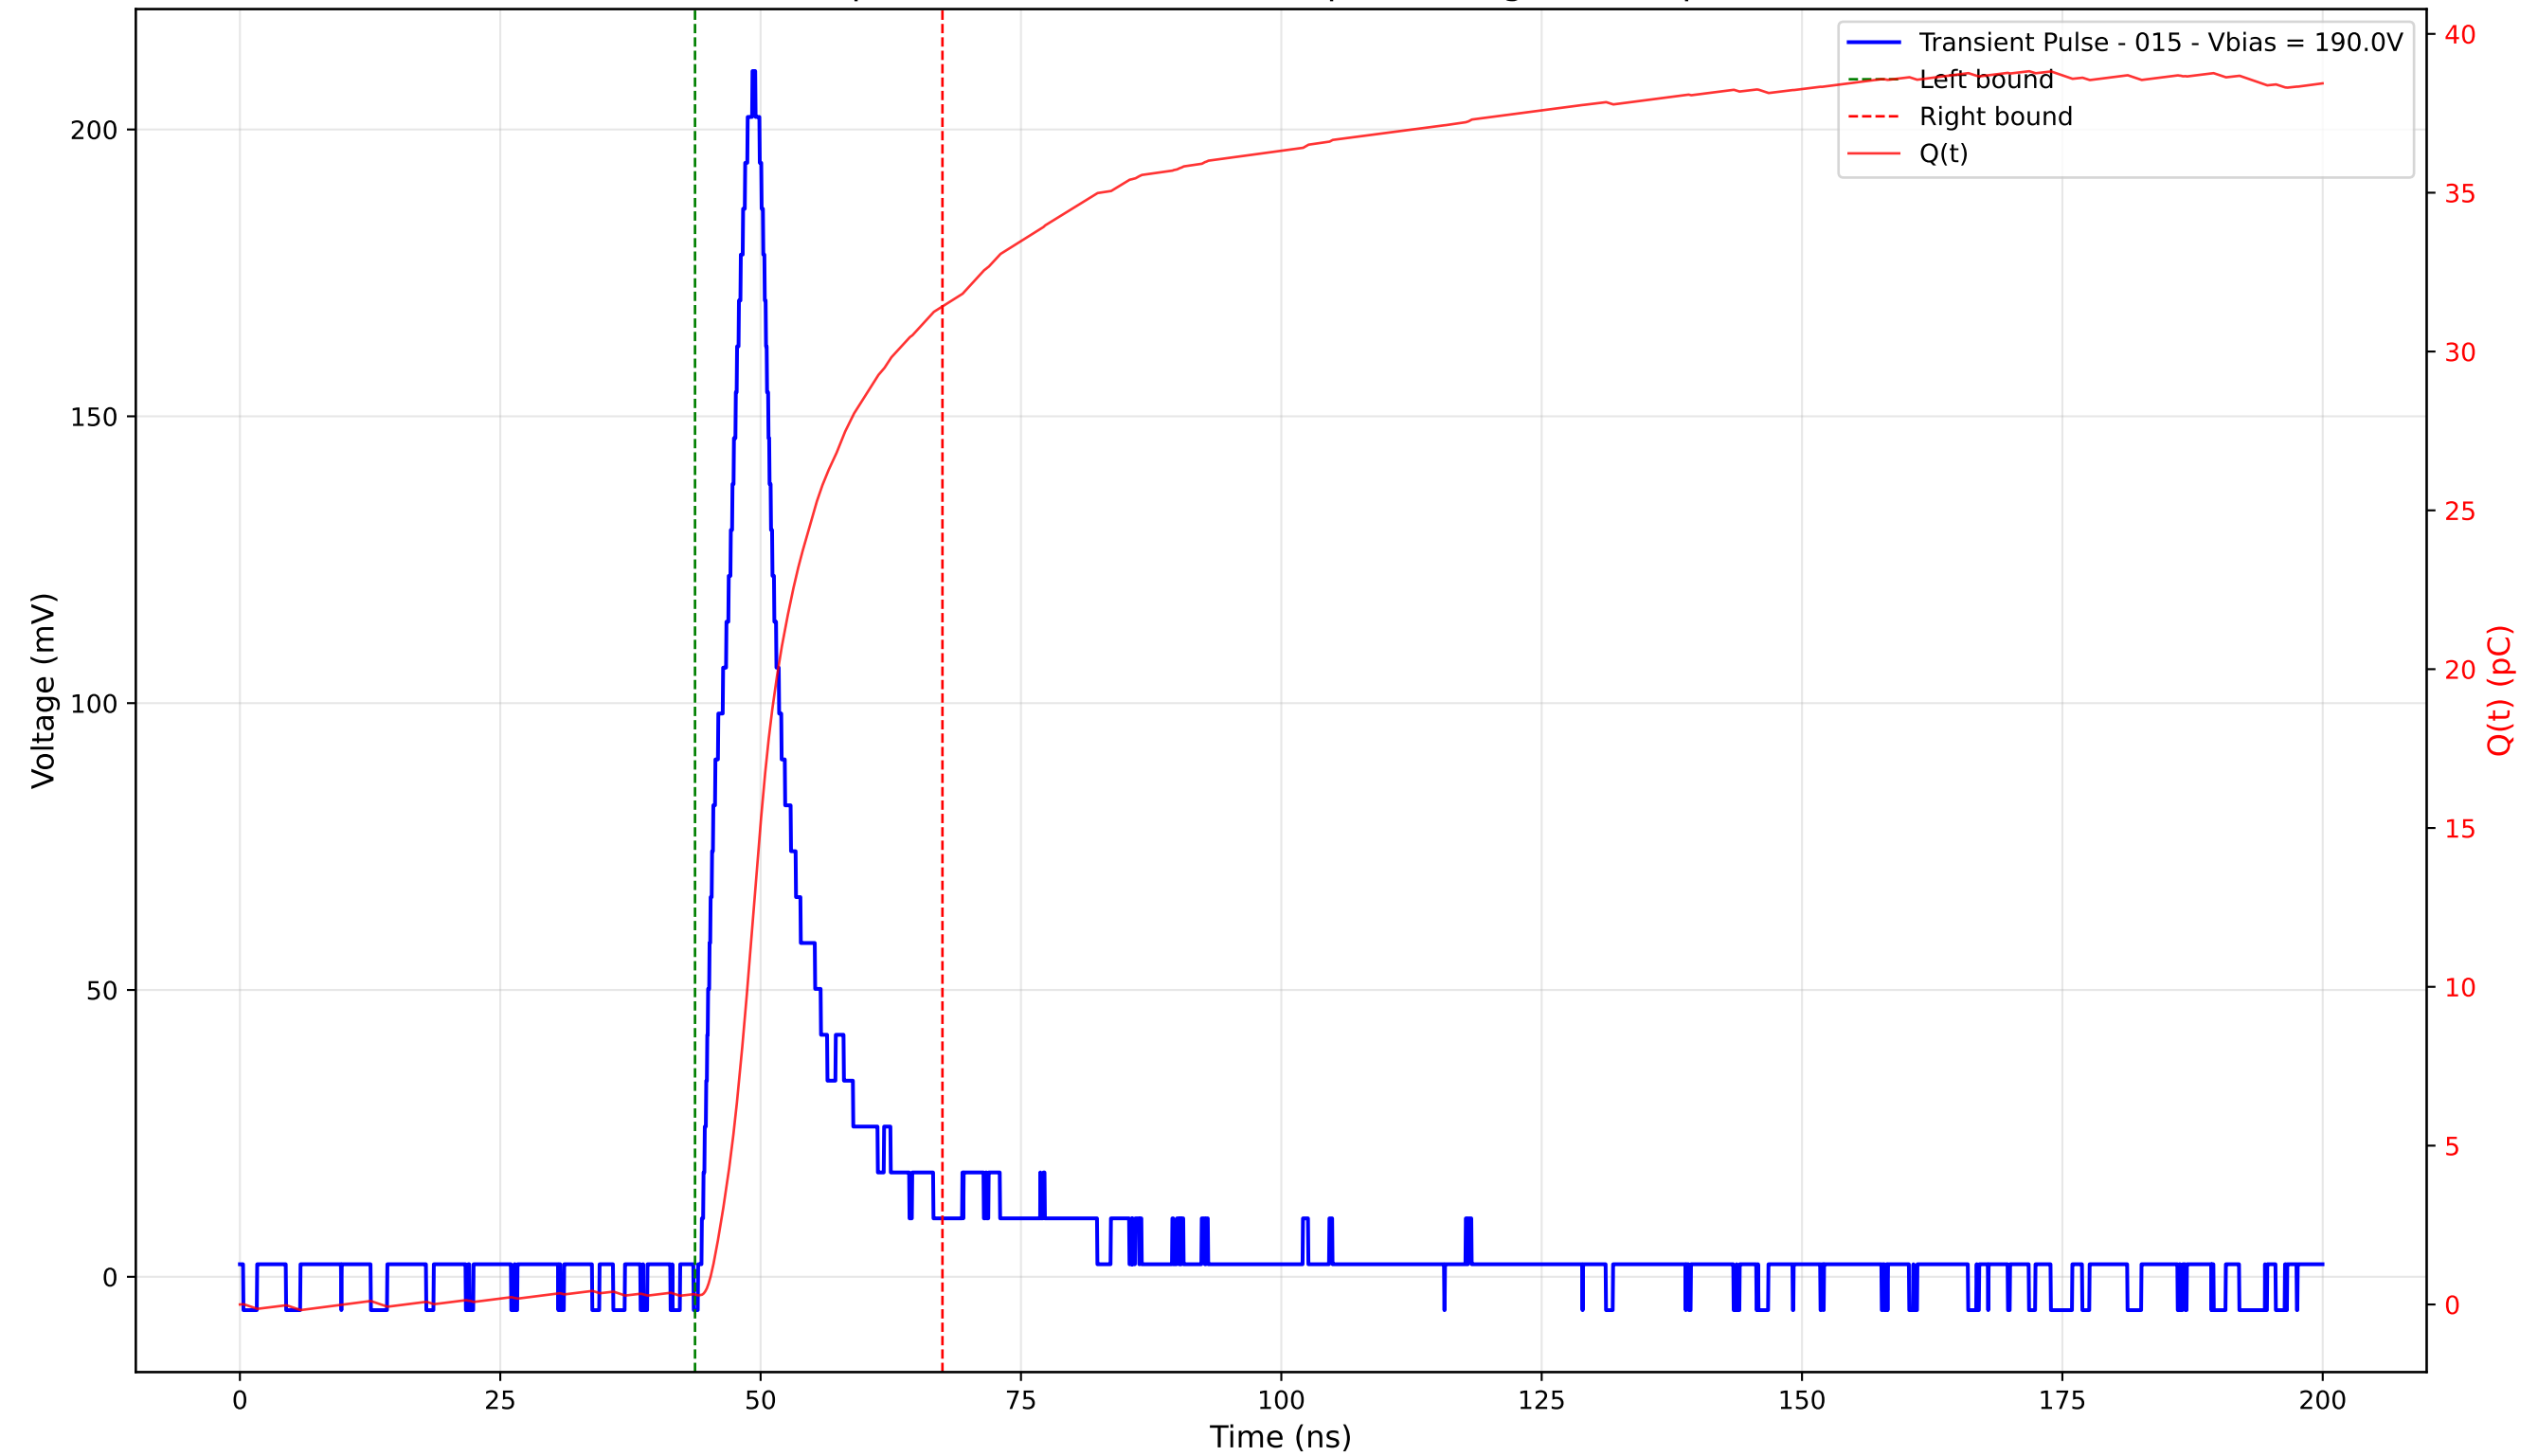


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 29.27 pC - Rise Time: 3.73 ns

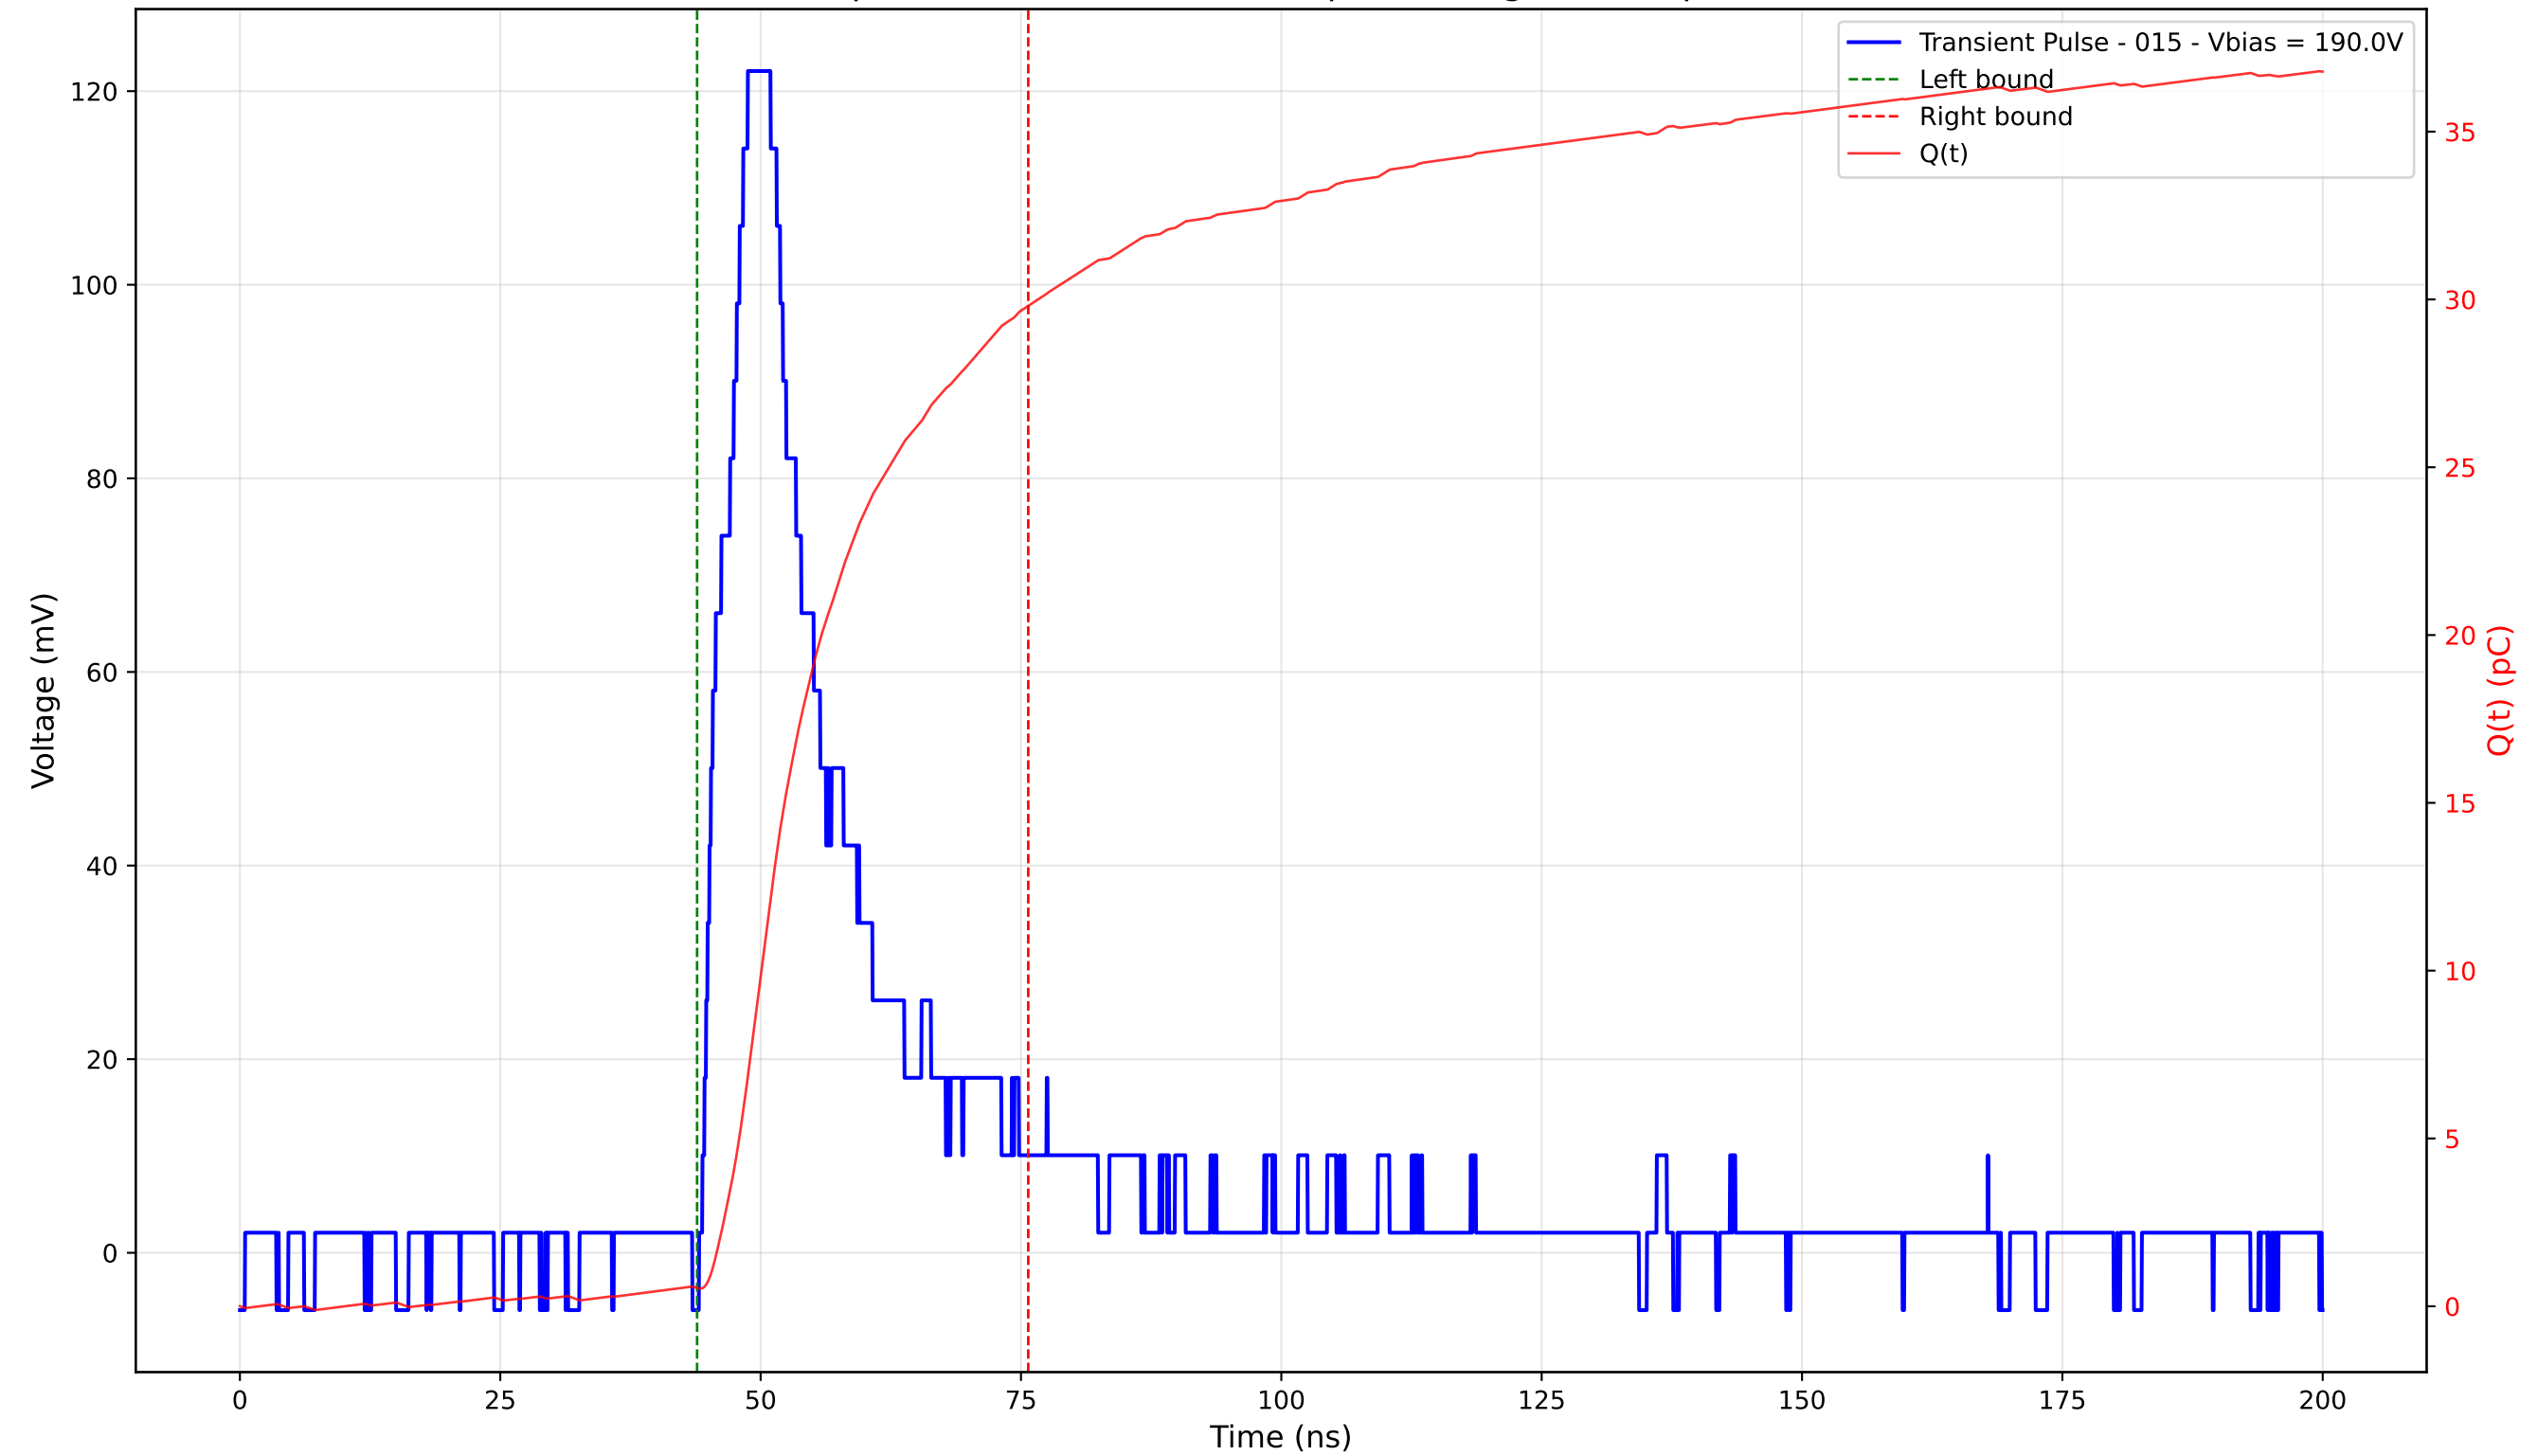


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 25.81 pC - Rise Time: 4.15 ns

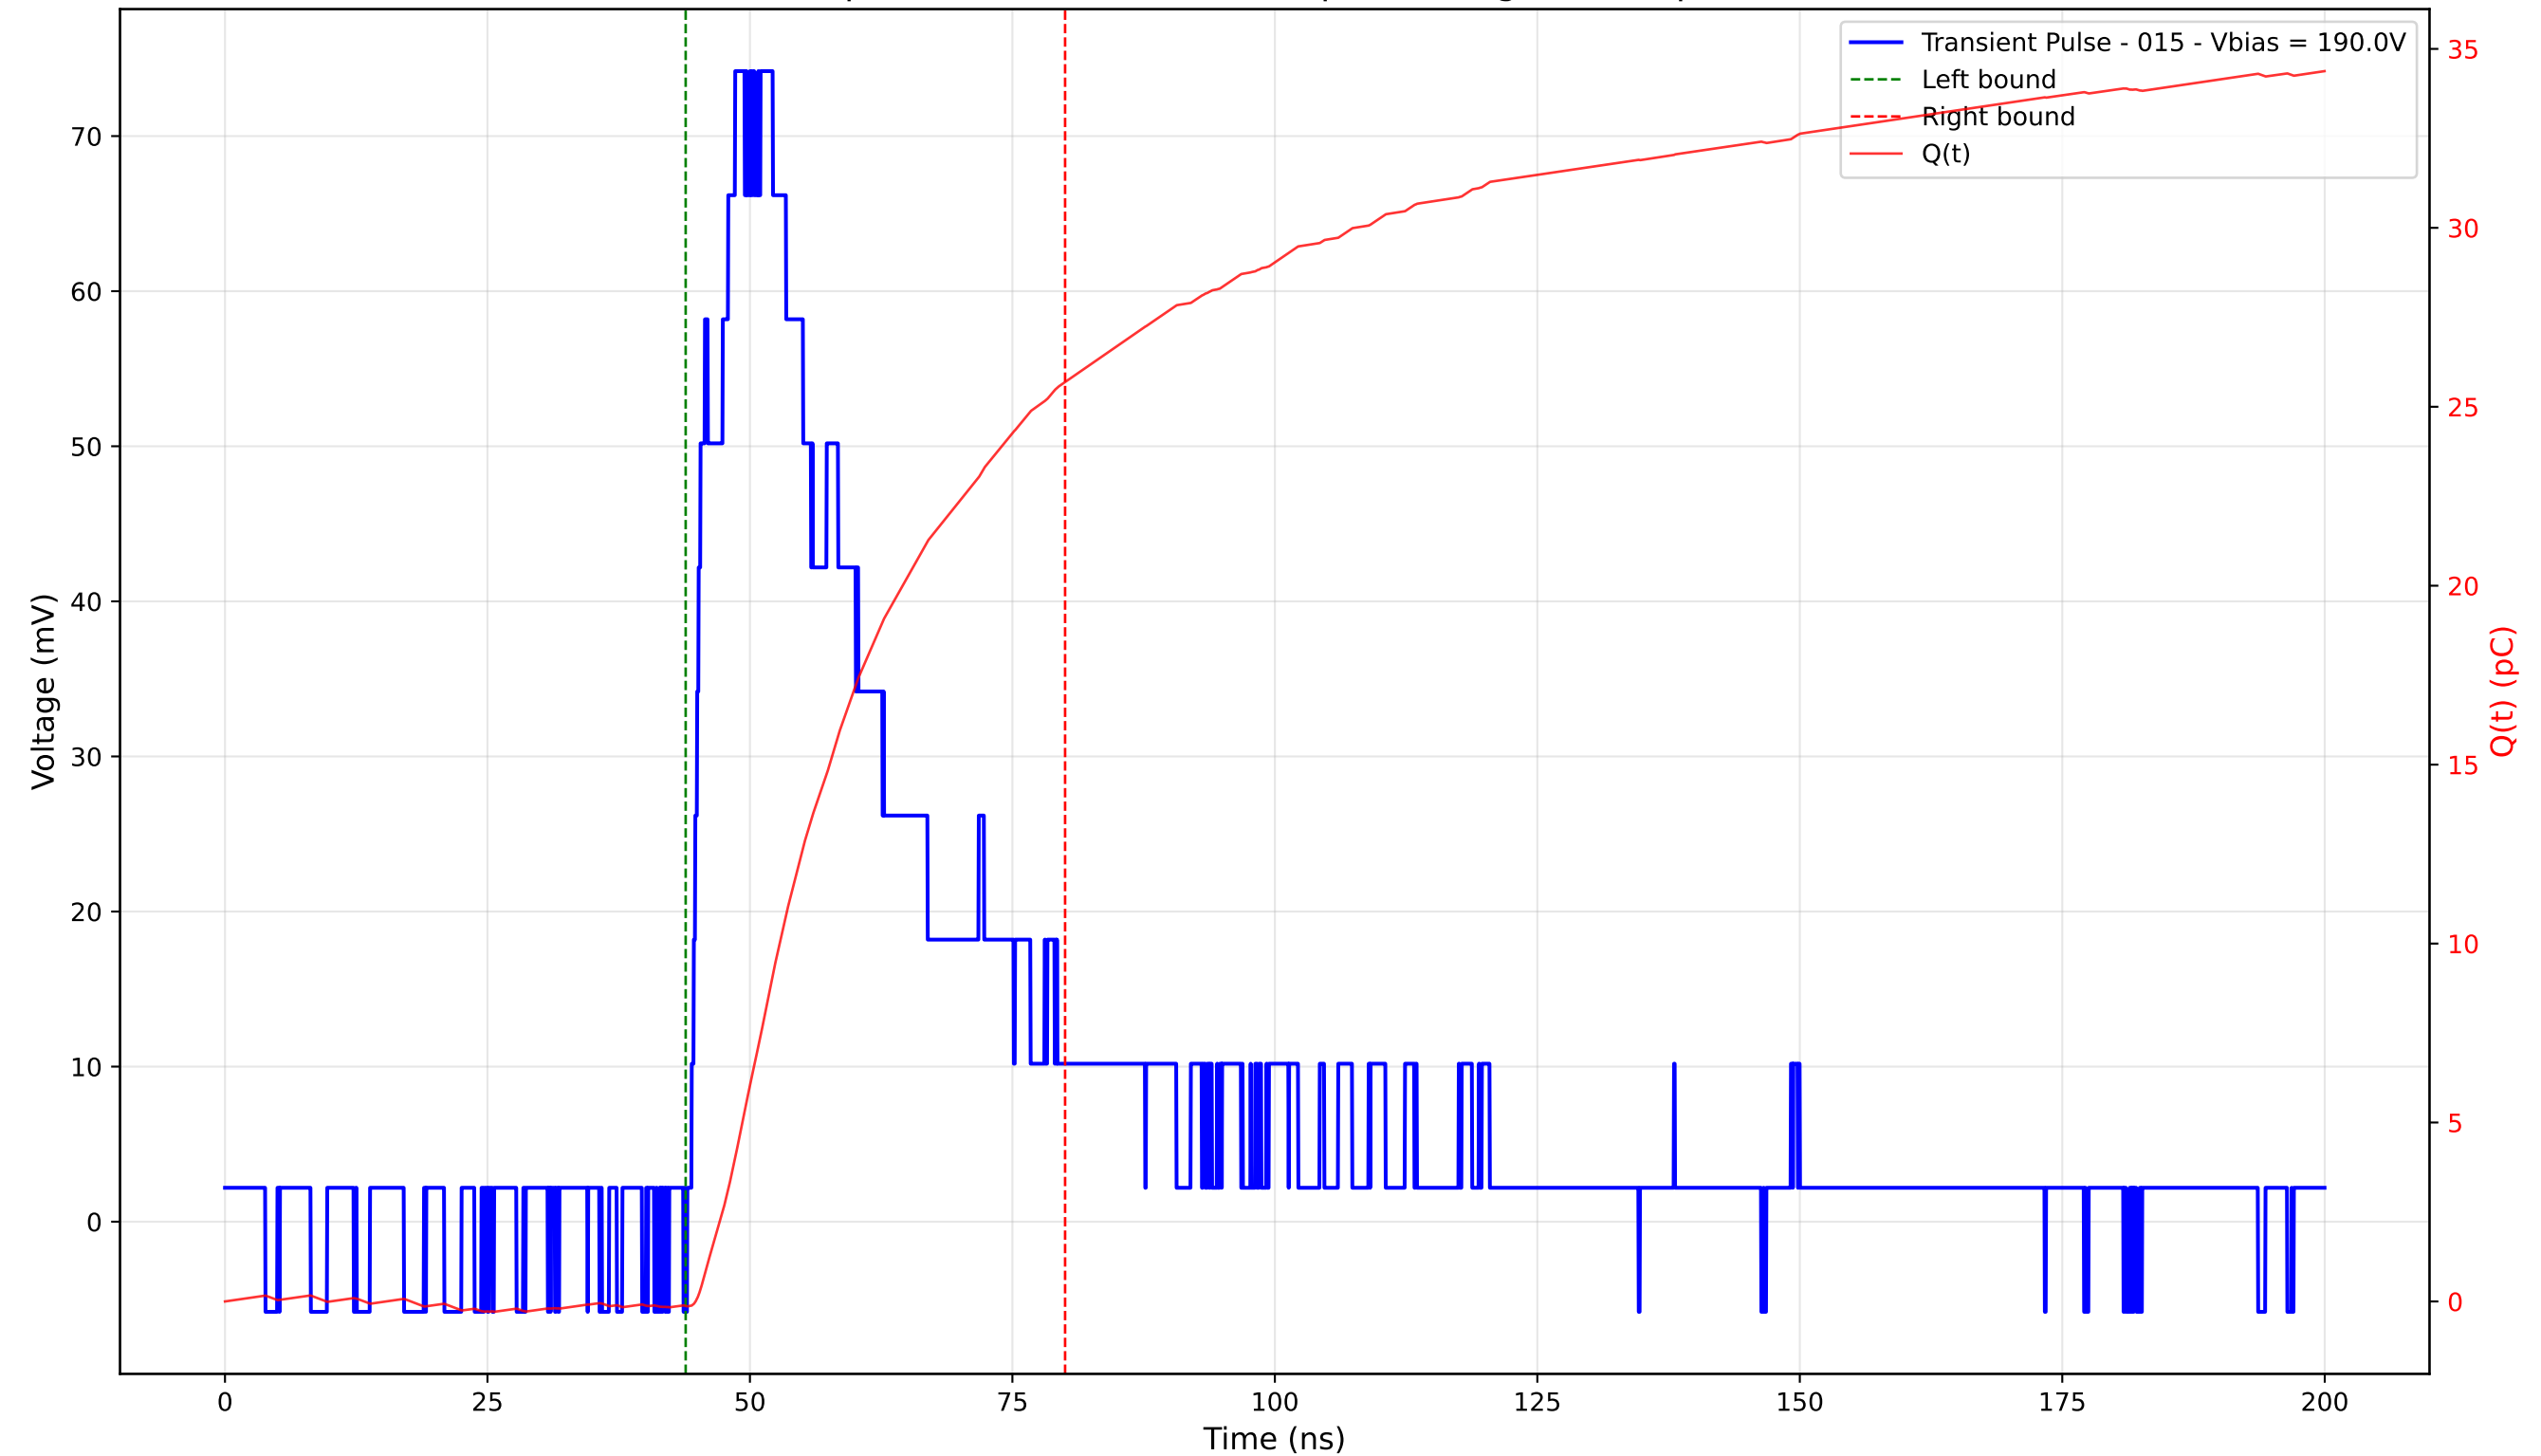


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 26.34 pC - Rise Time: 1.15 ns

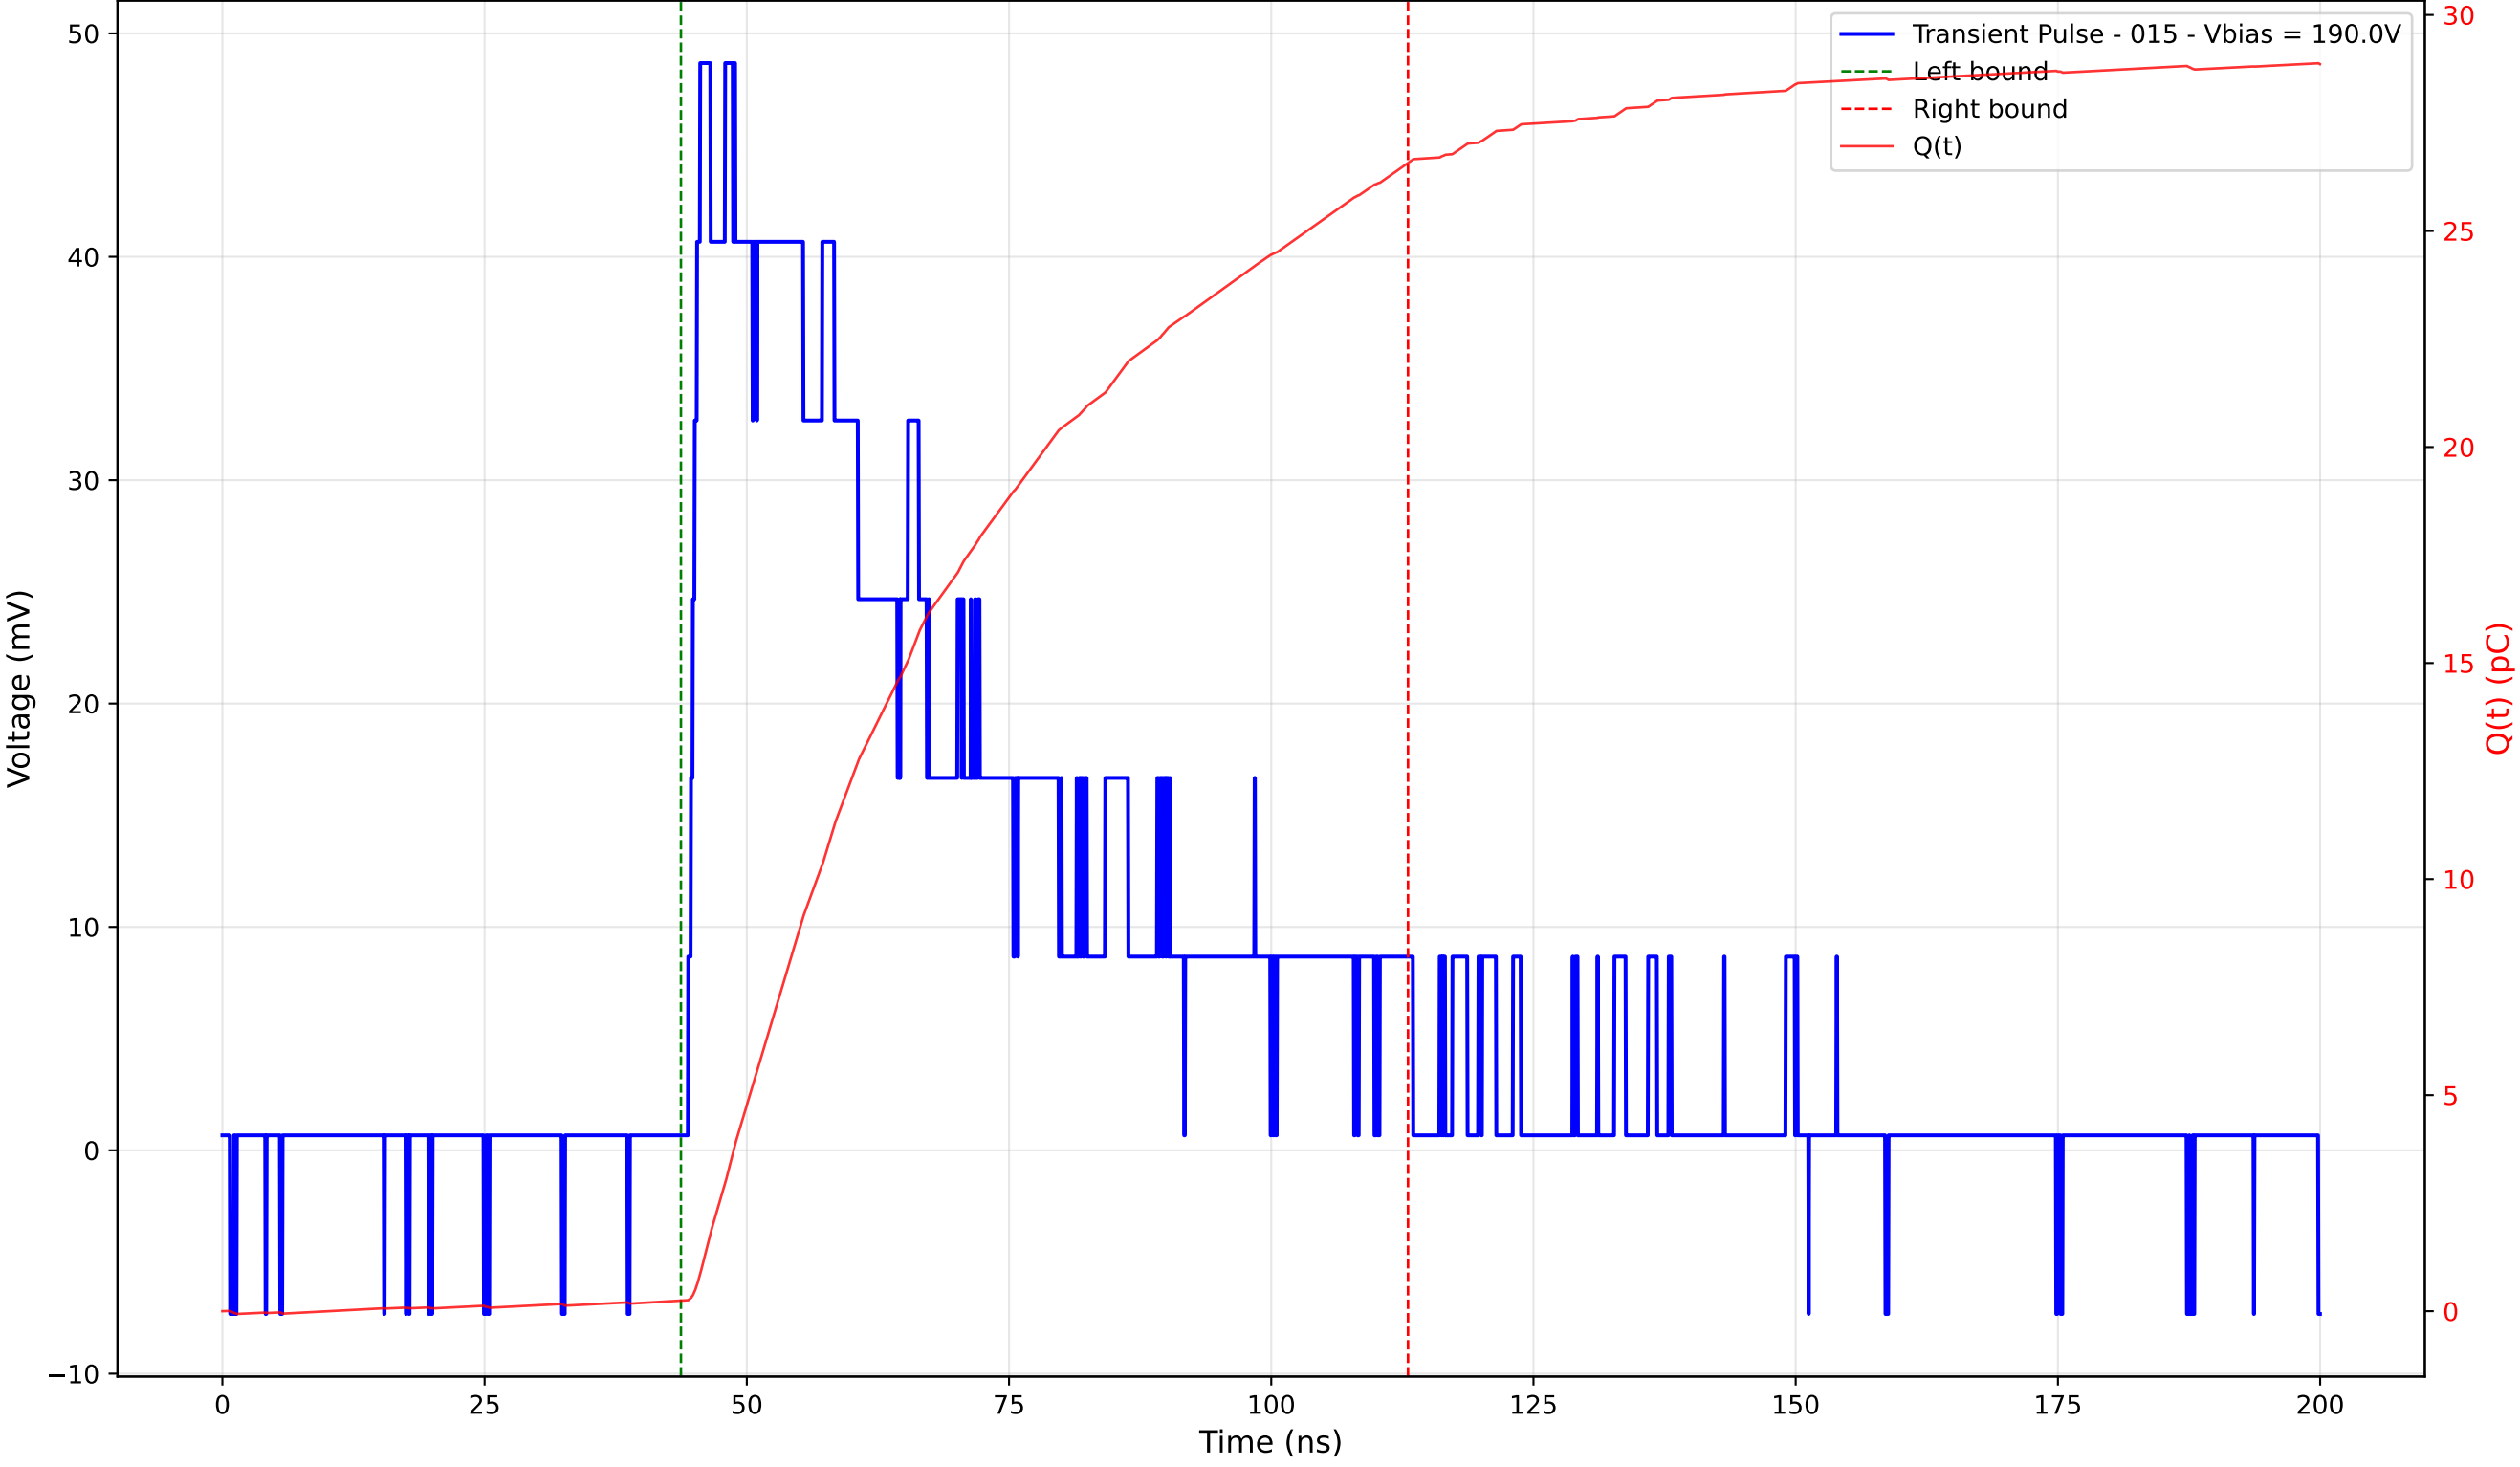


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 20.30 pC - Rise Time: 0.89 ns

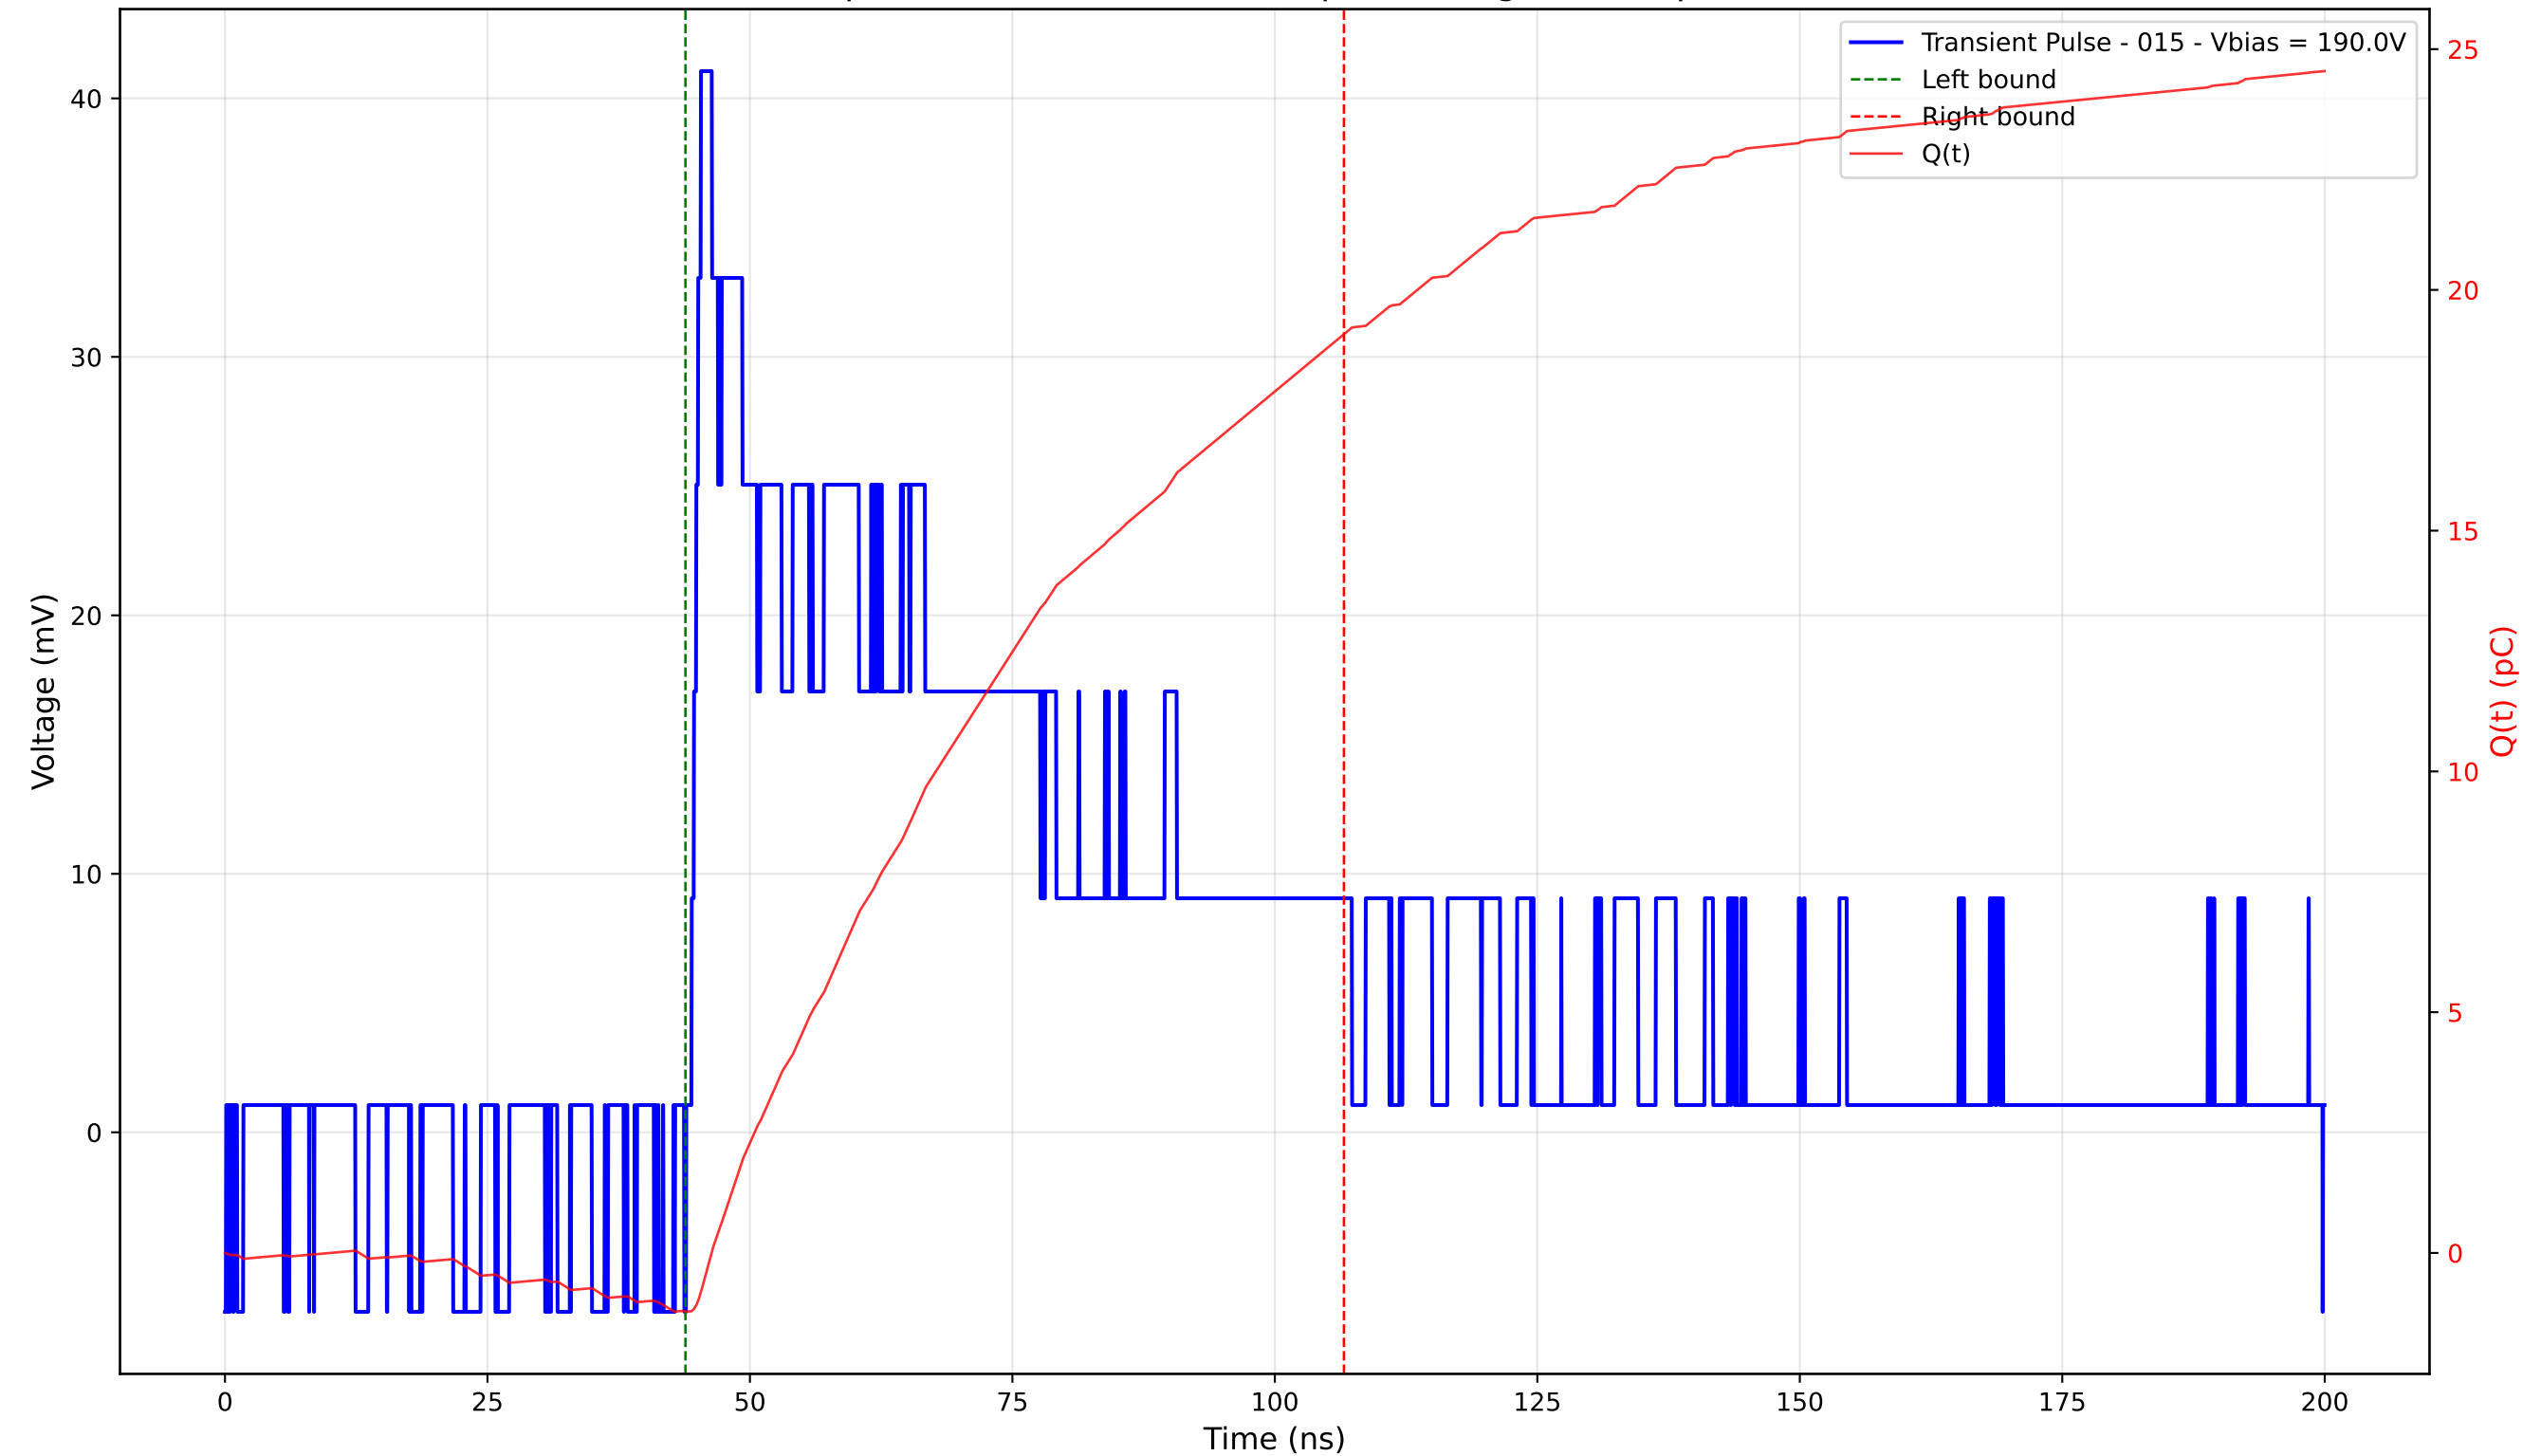


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 15.33 pC - Rise Time: 0.89 ns

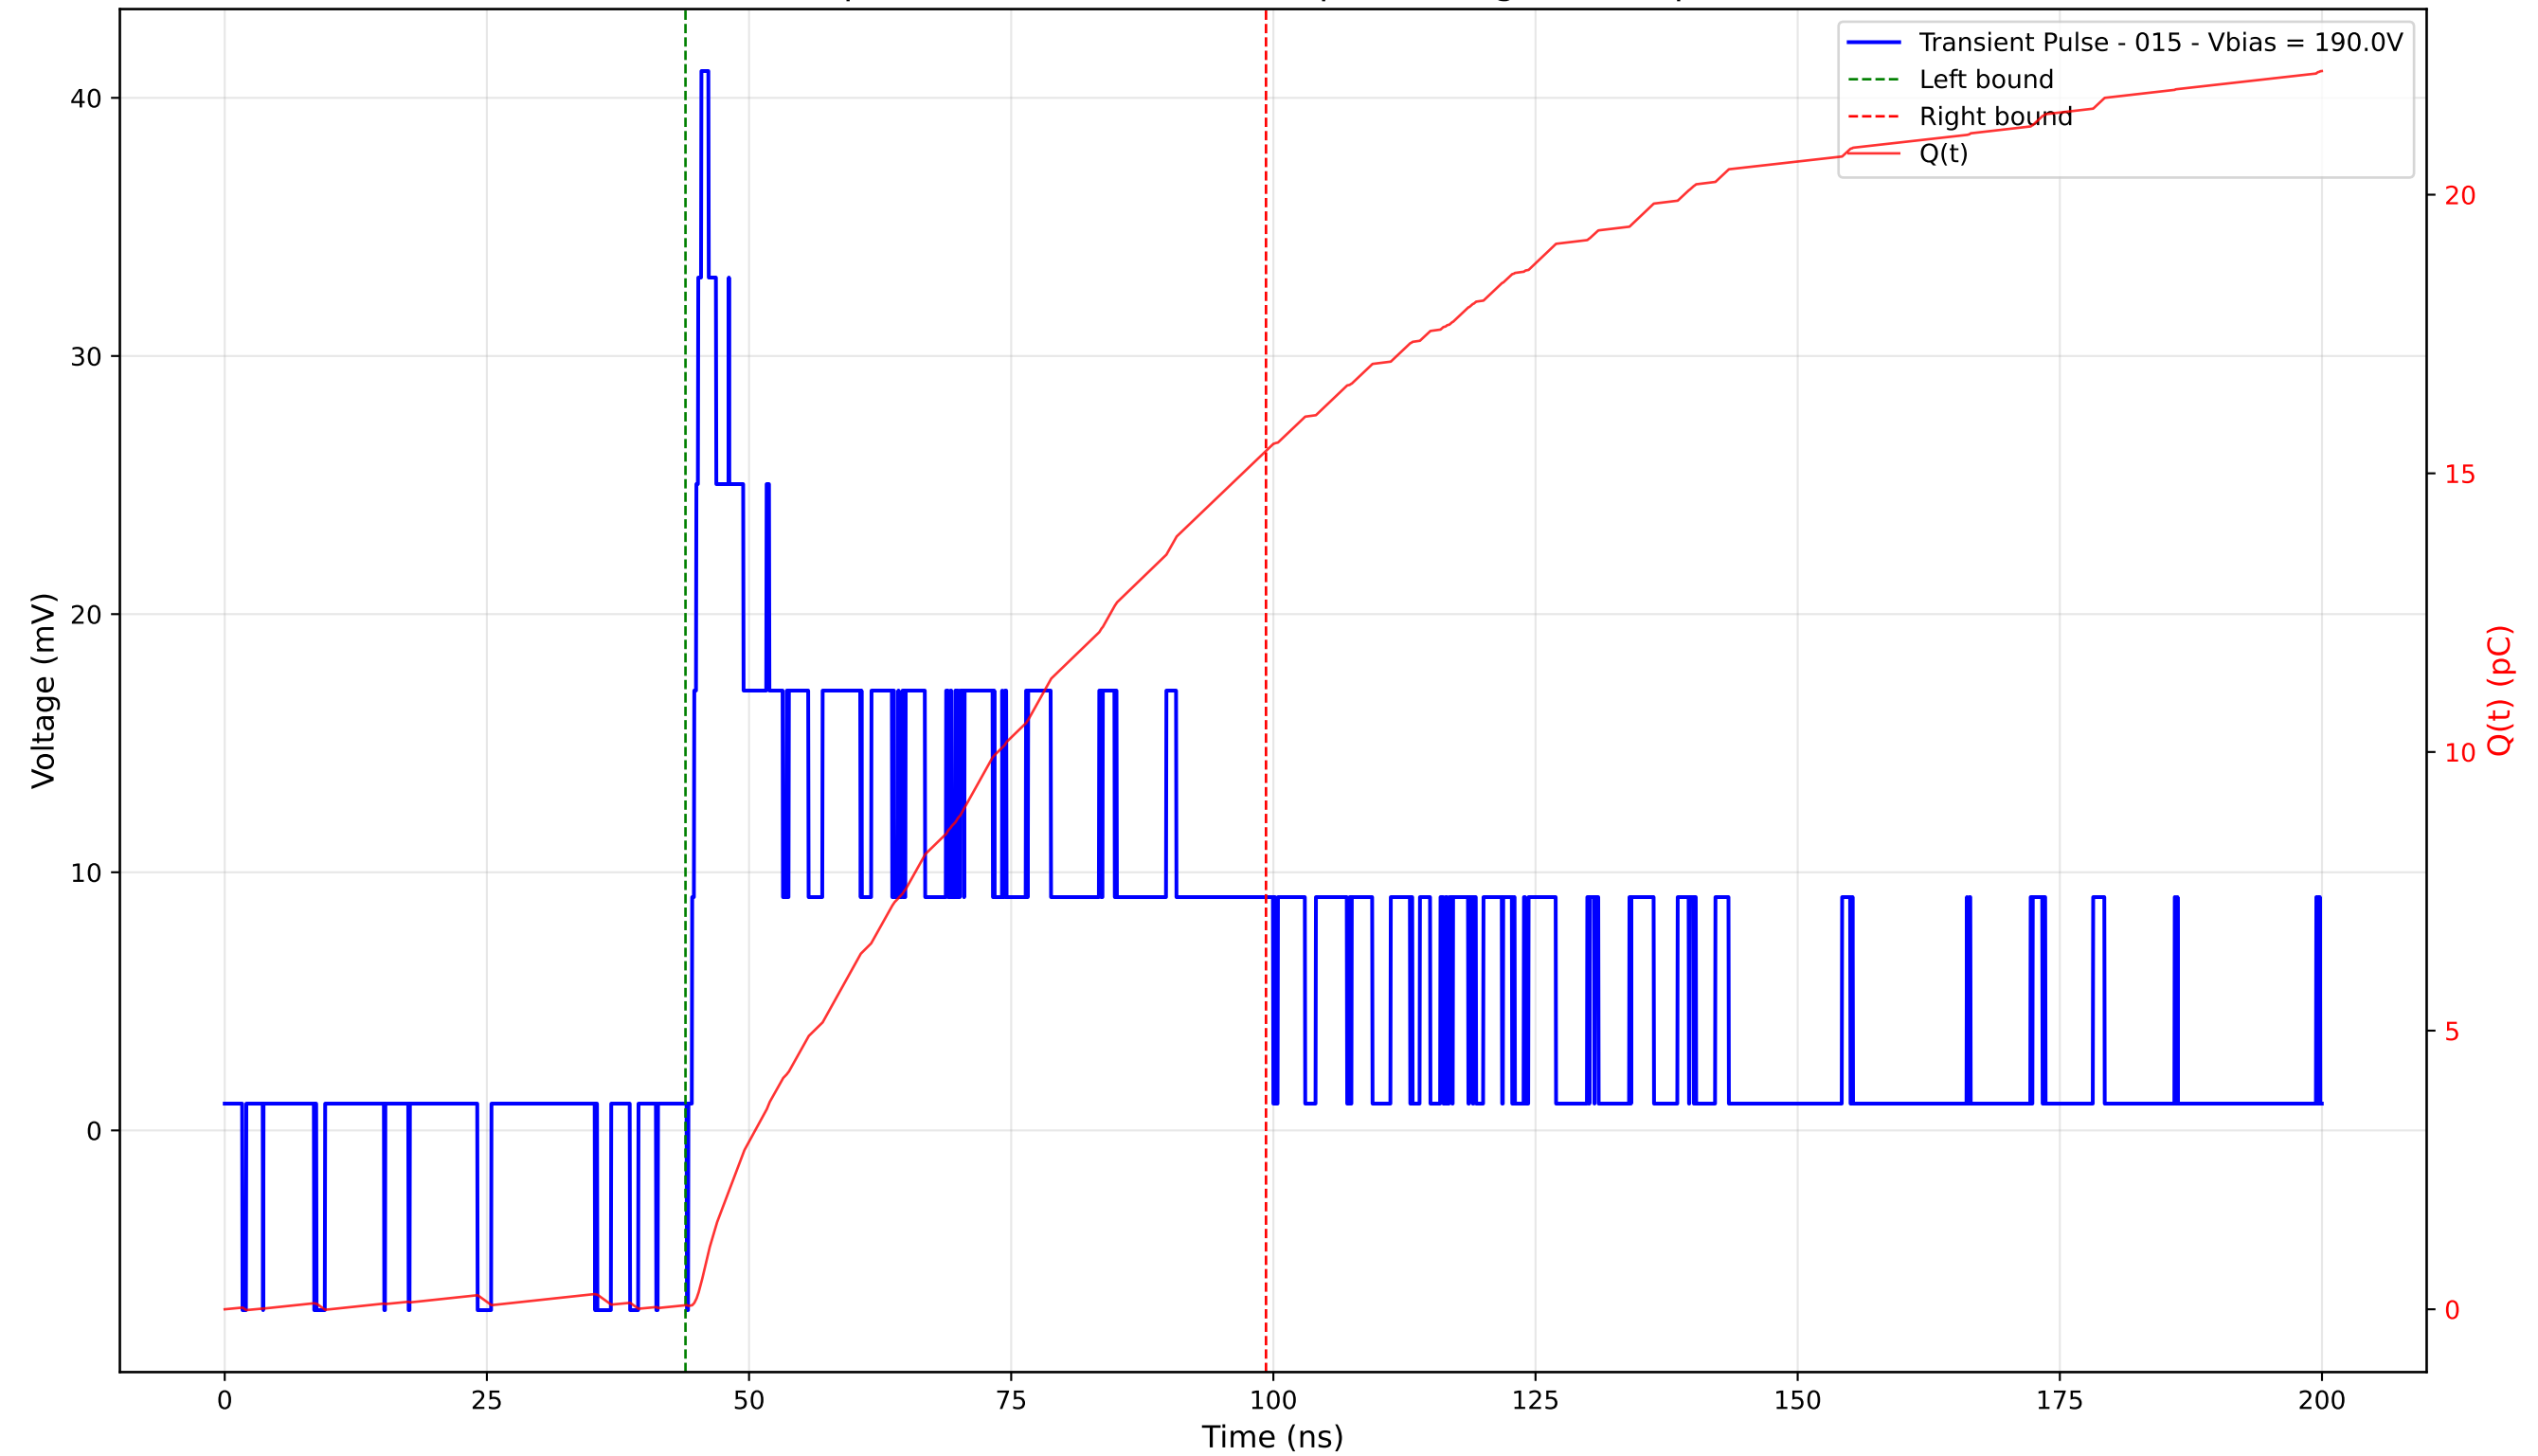


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 4.32 pC - Rise Time: 1.15 ns

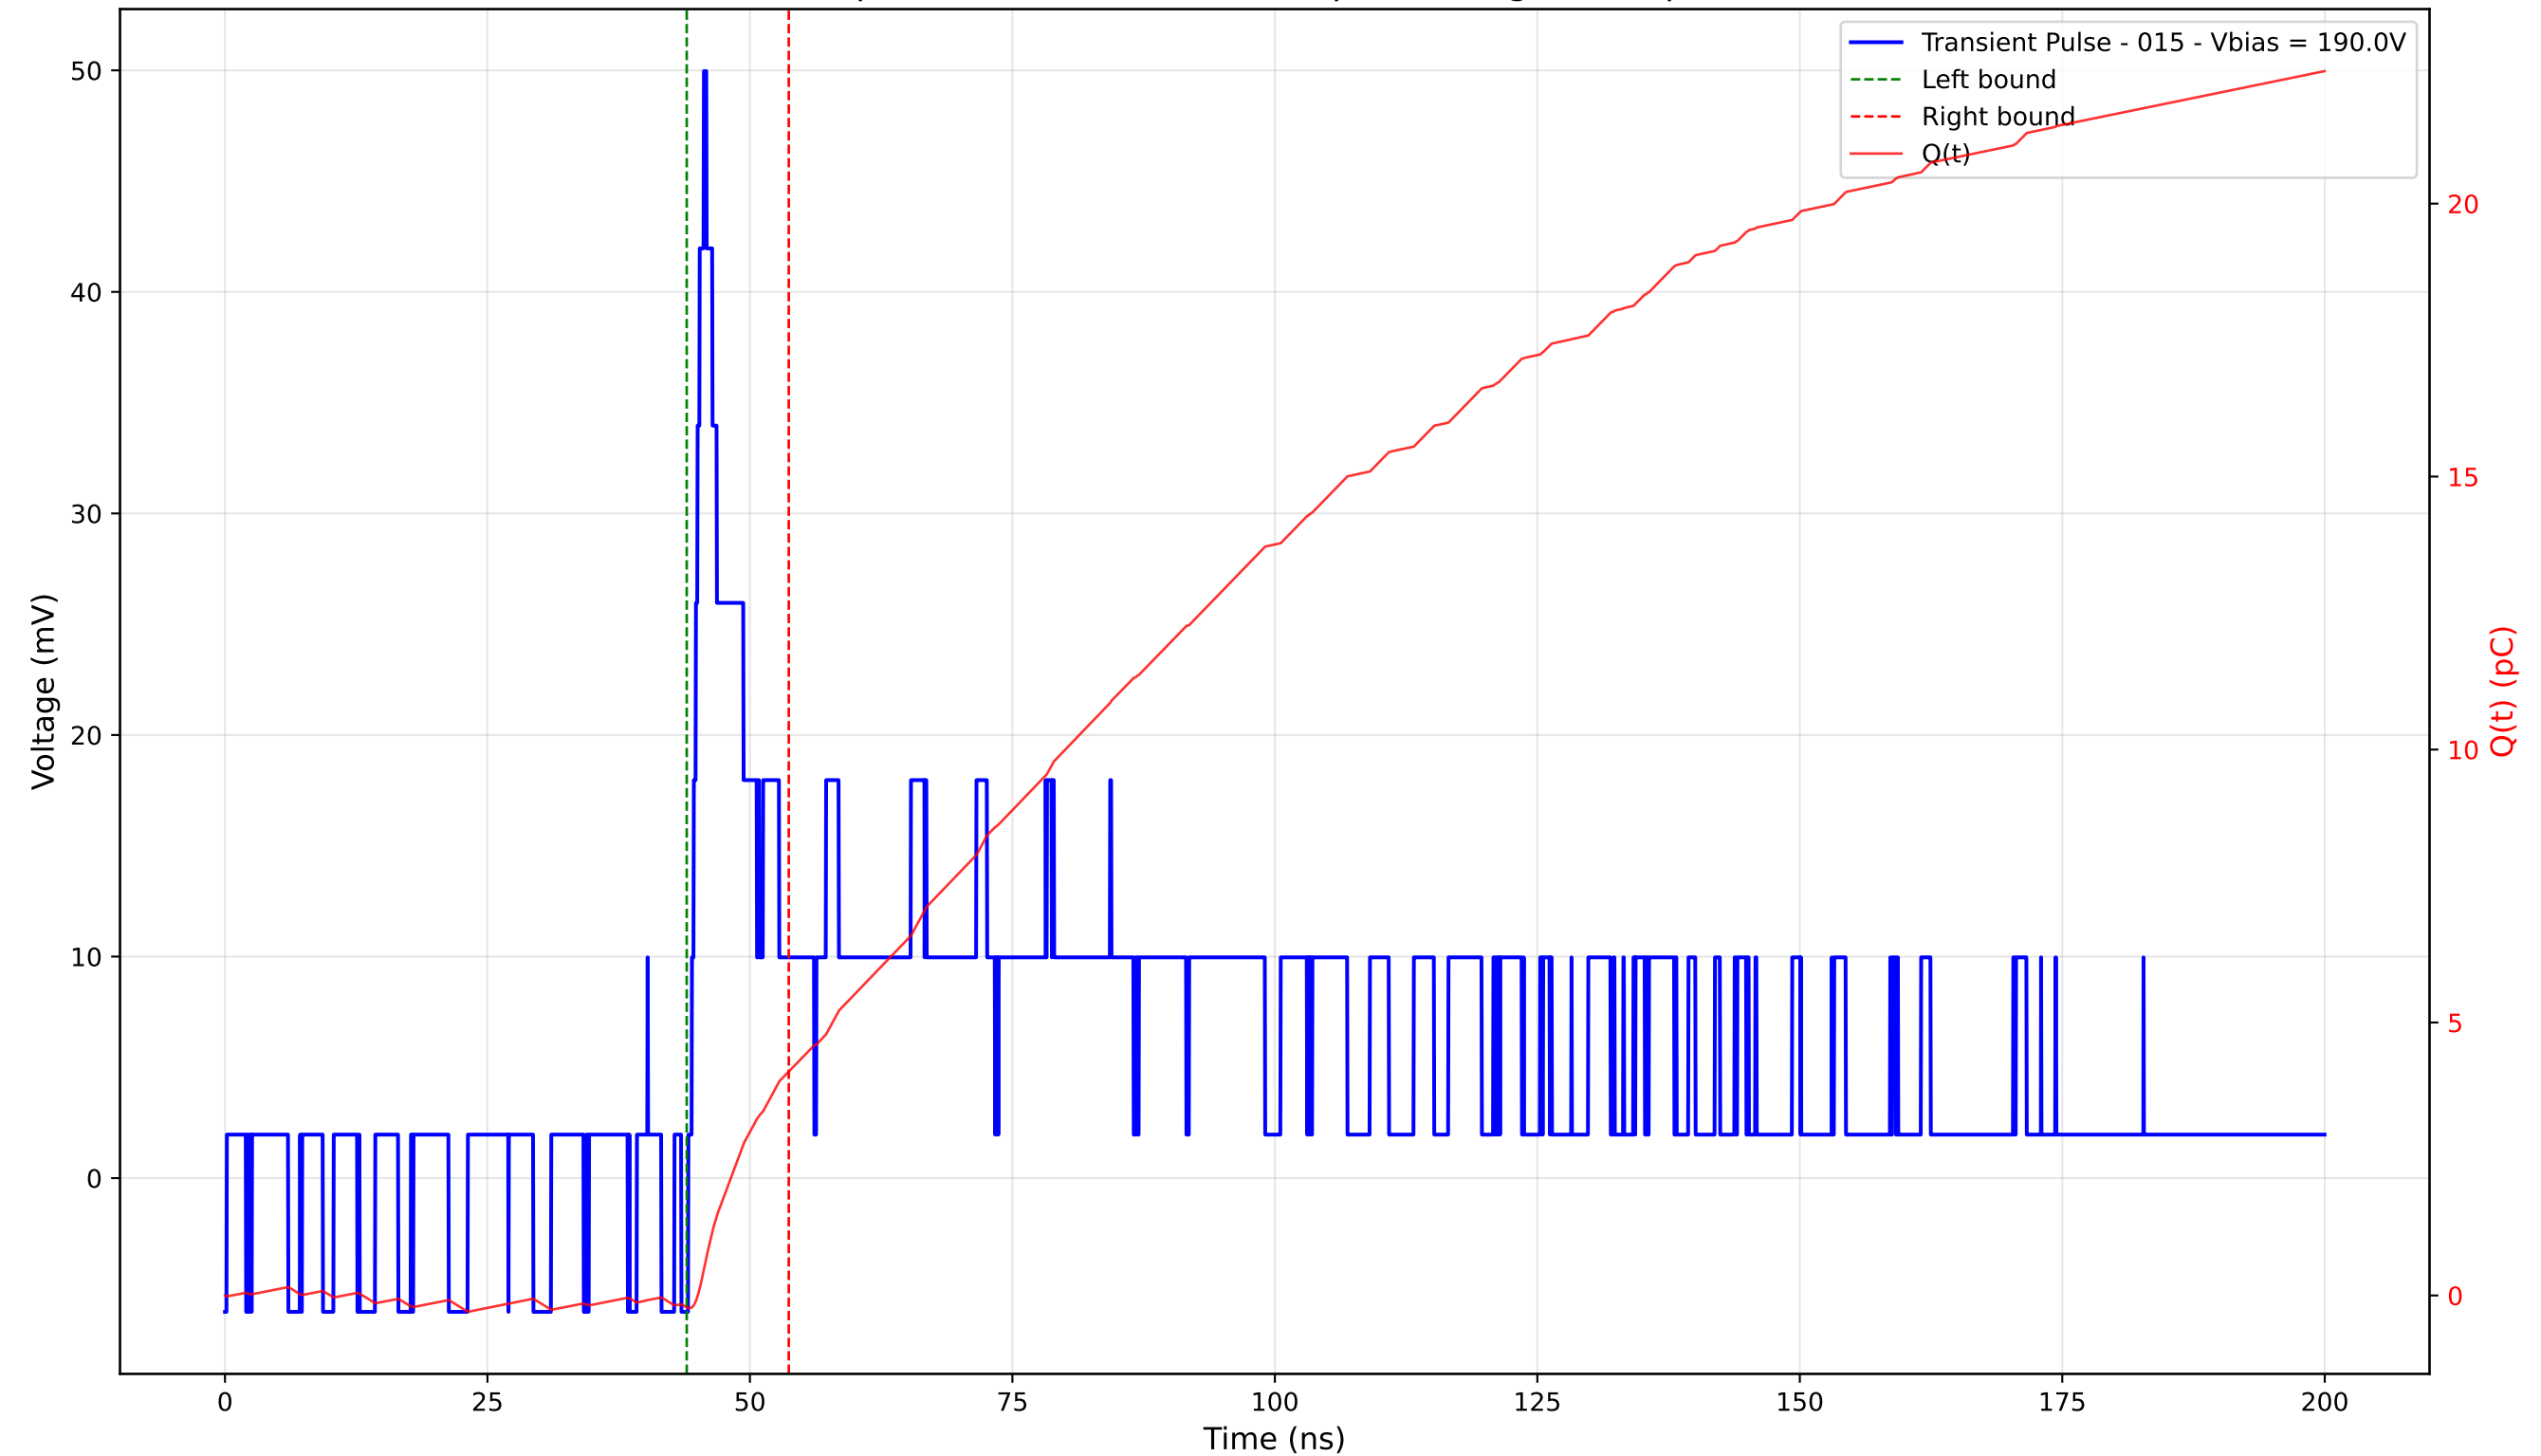


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 3.57 pC - Rise Time: 1.29 ns

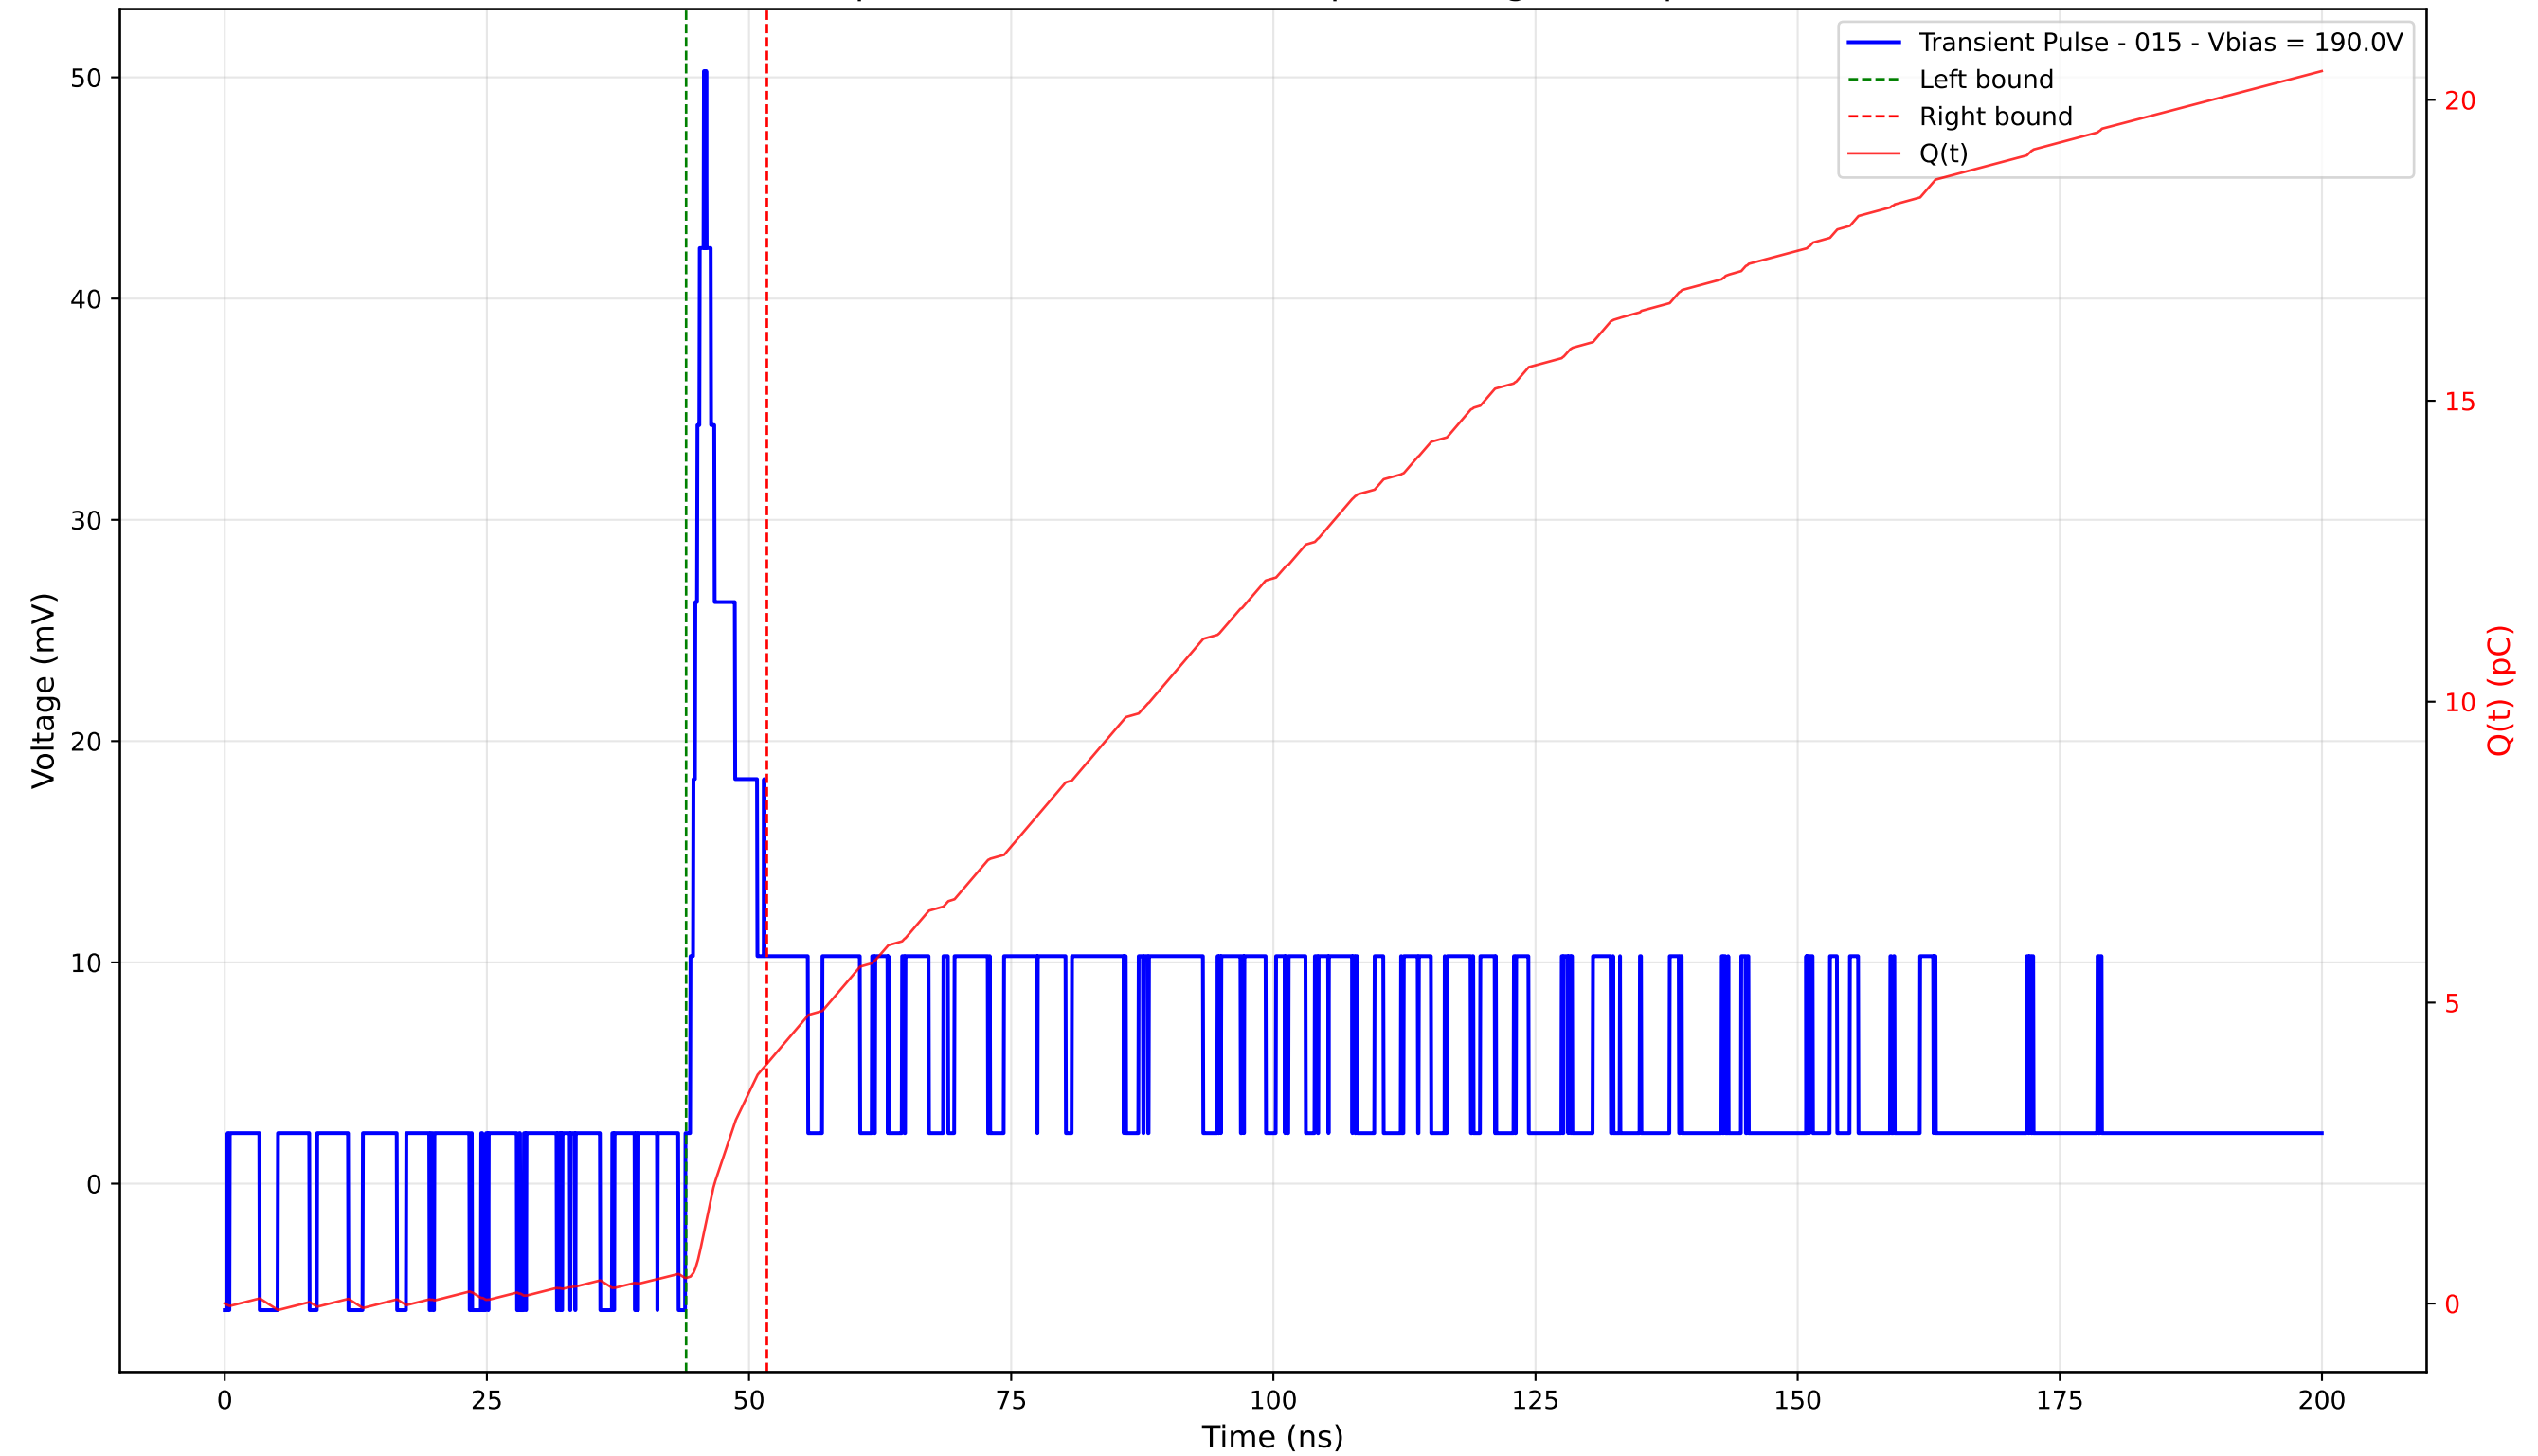


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 4.12 pC - Rise Time: 0.95 ns

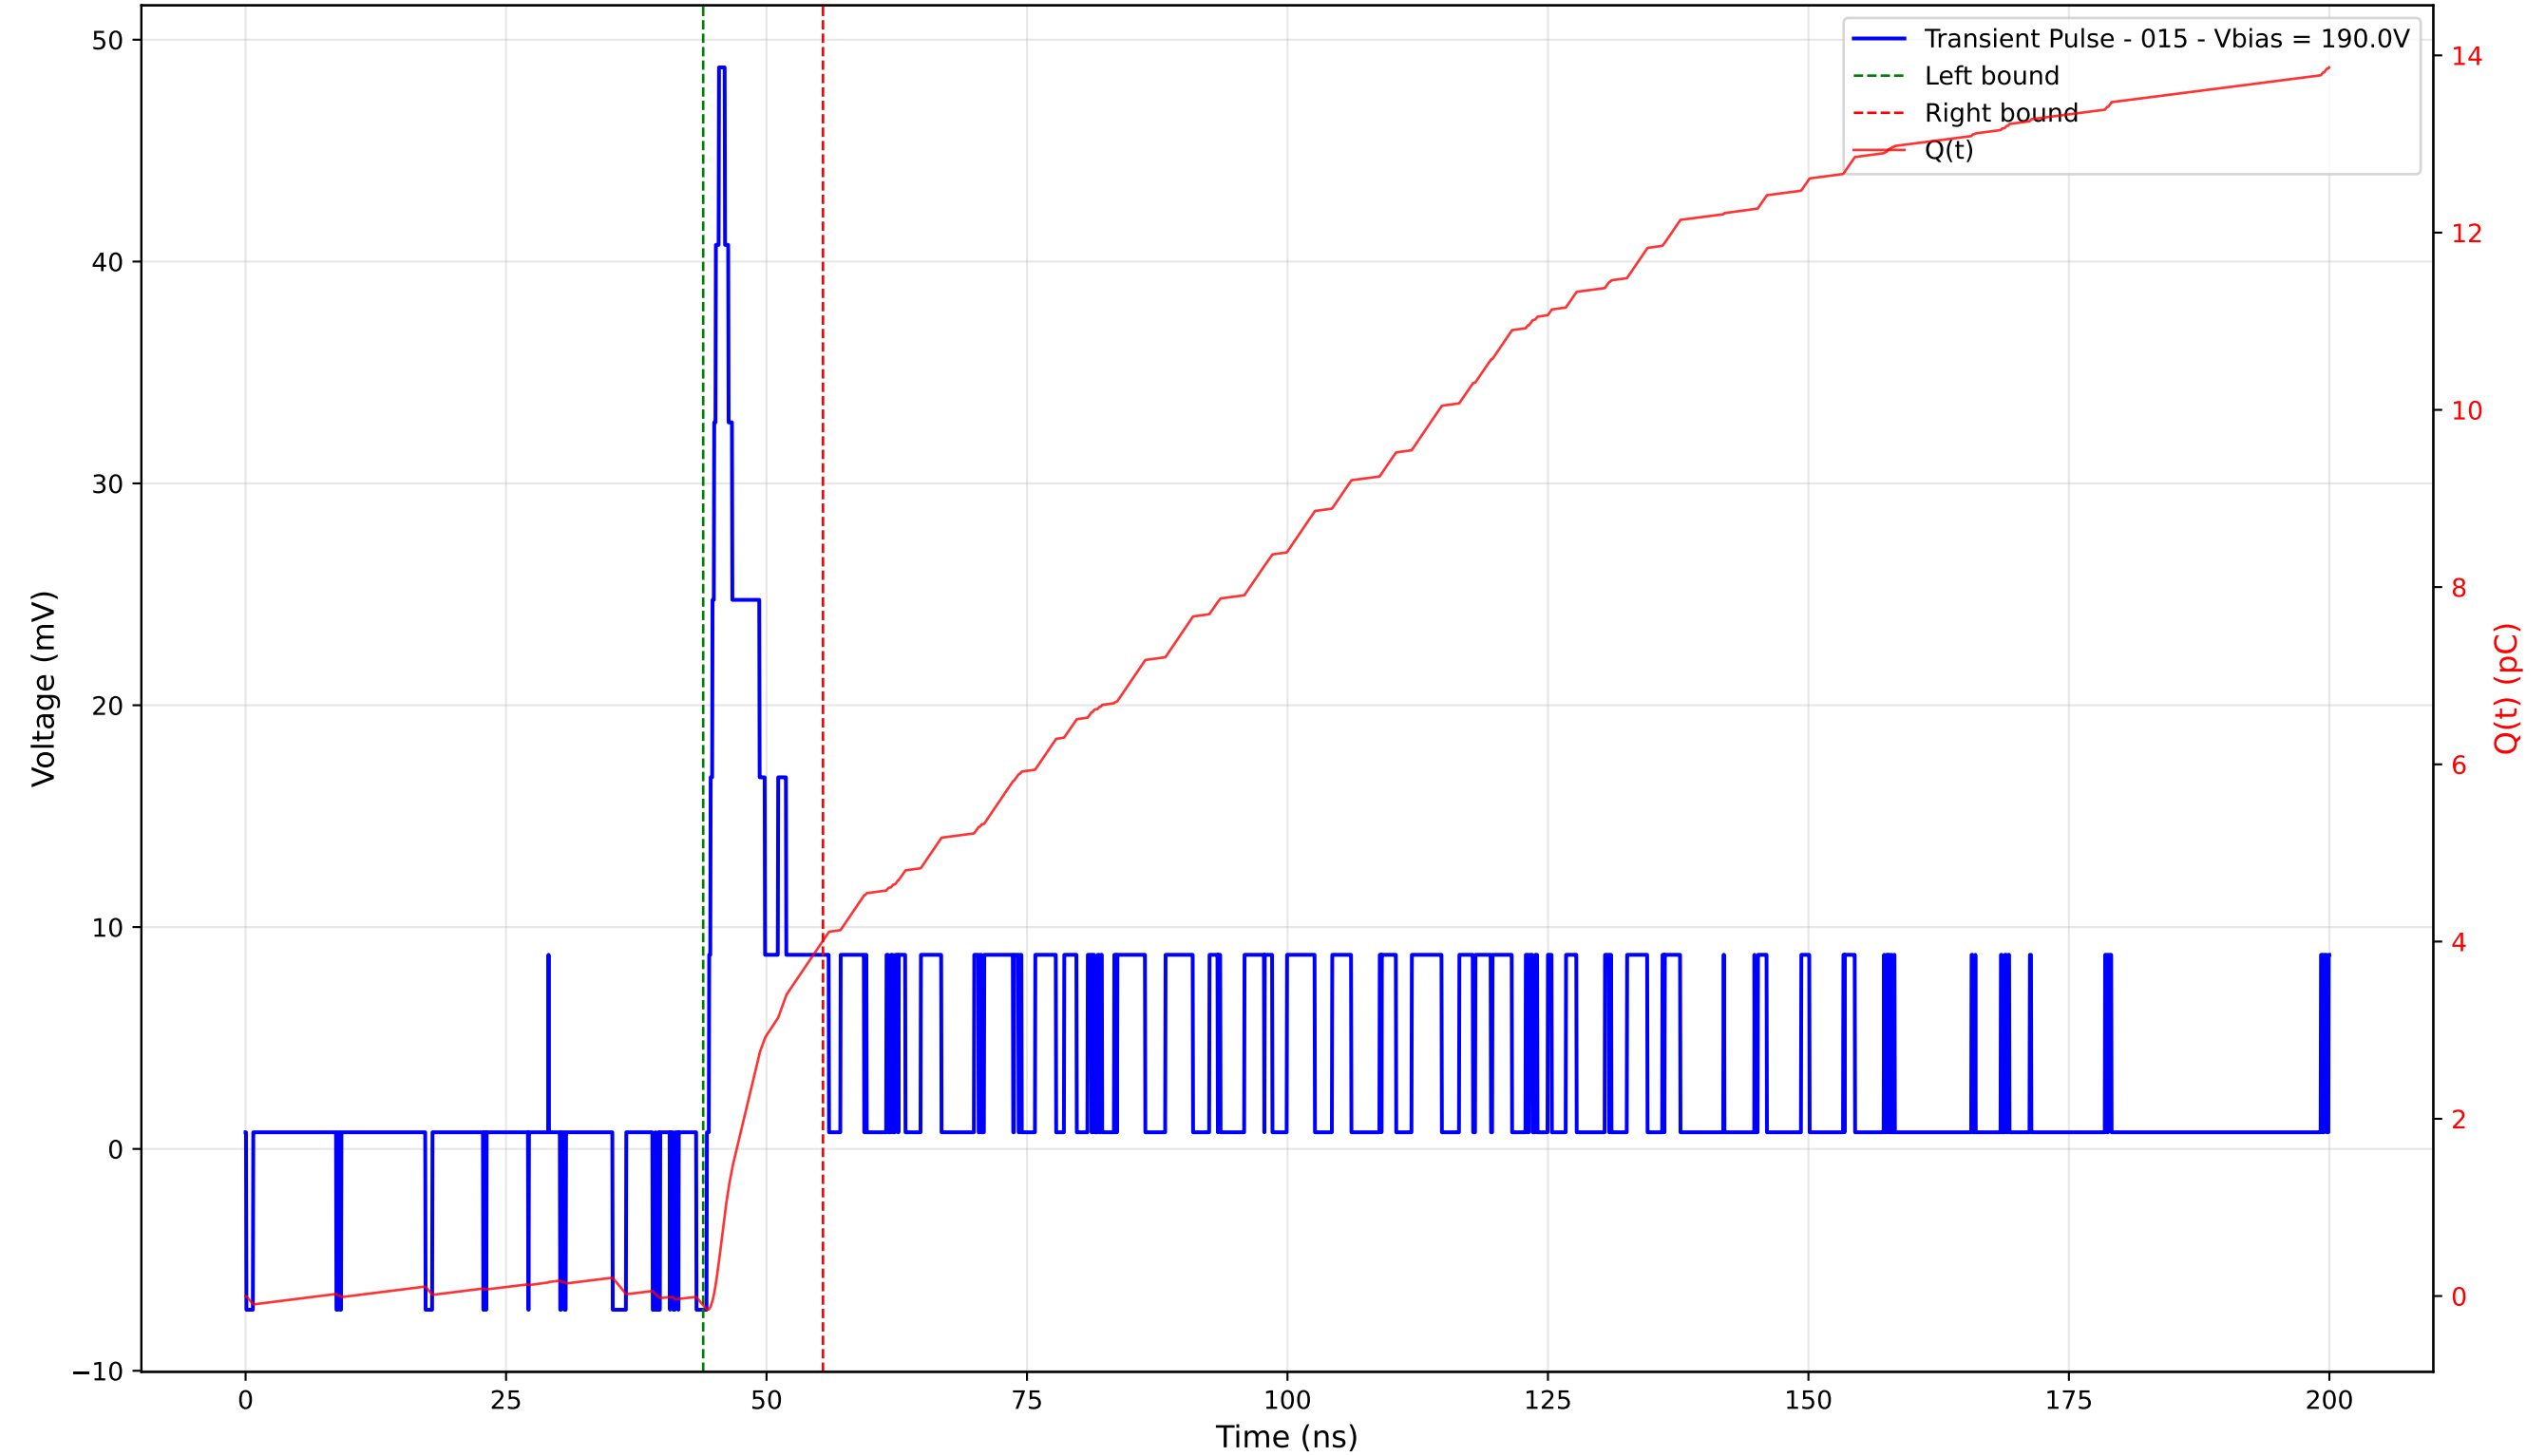


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.92 pC - Rise Time: 1.01 ns

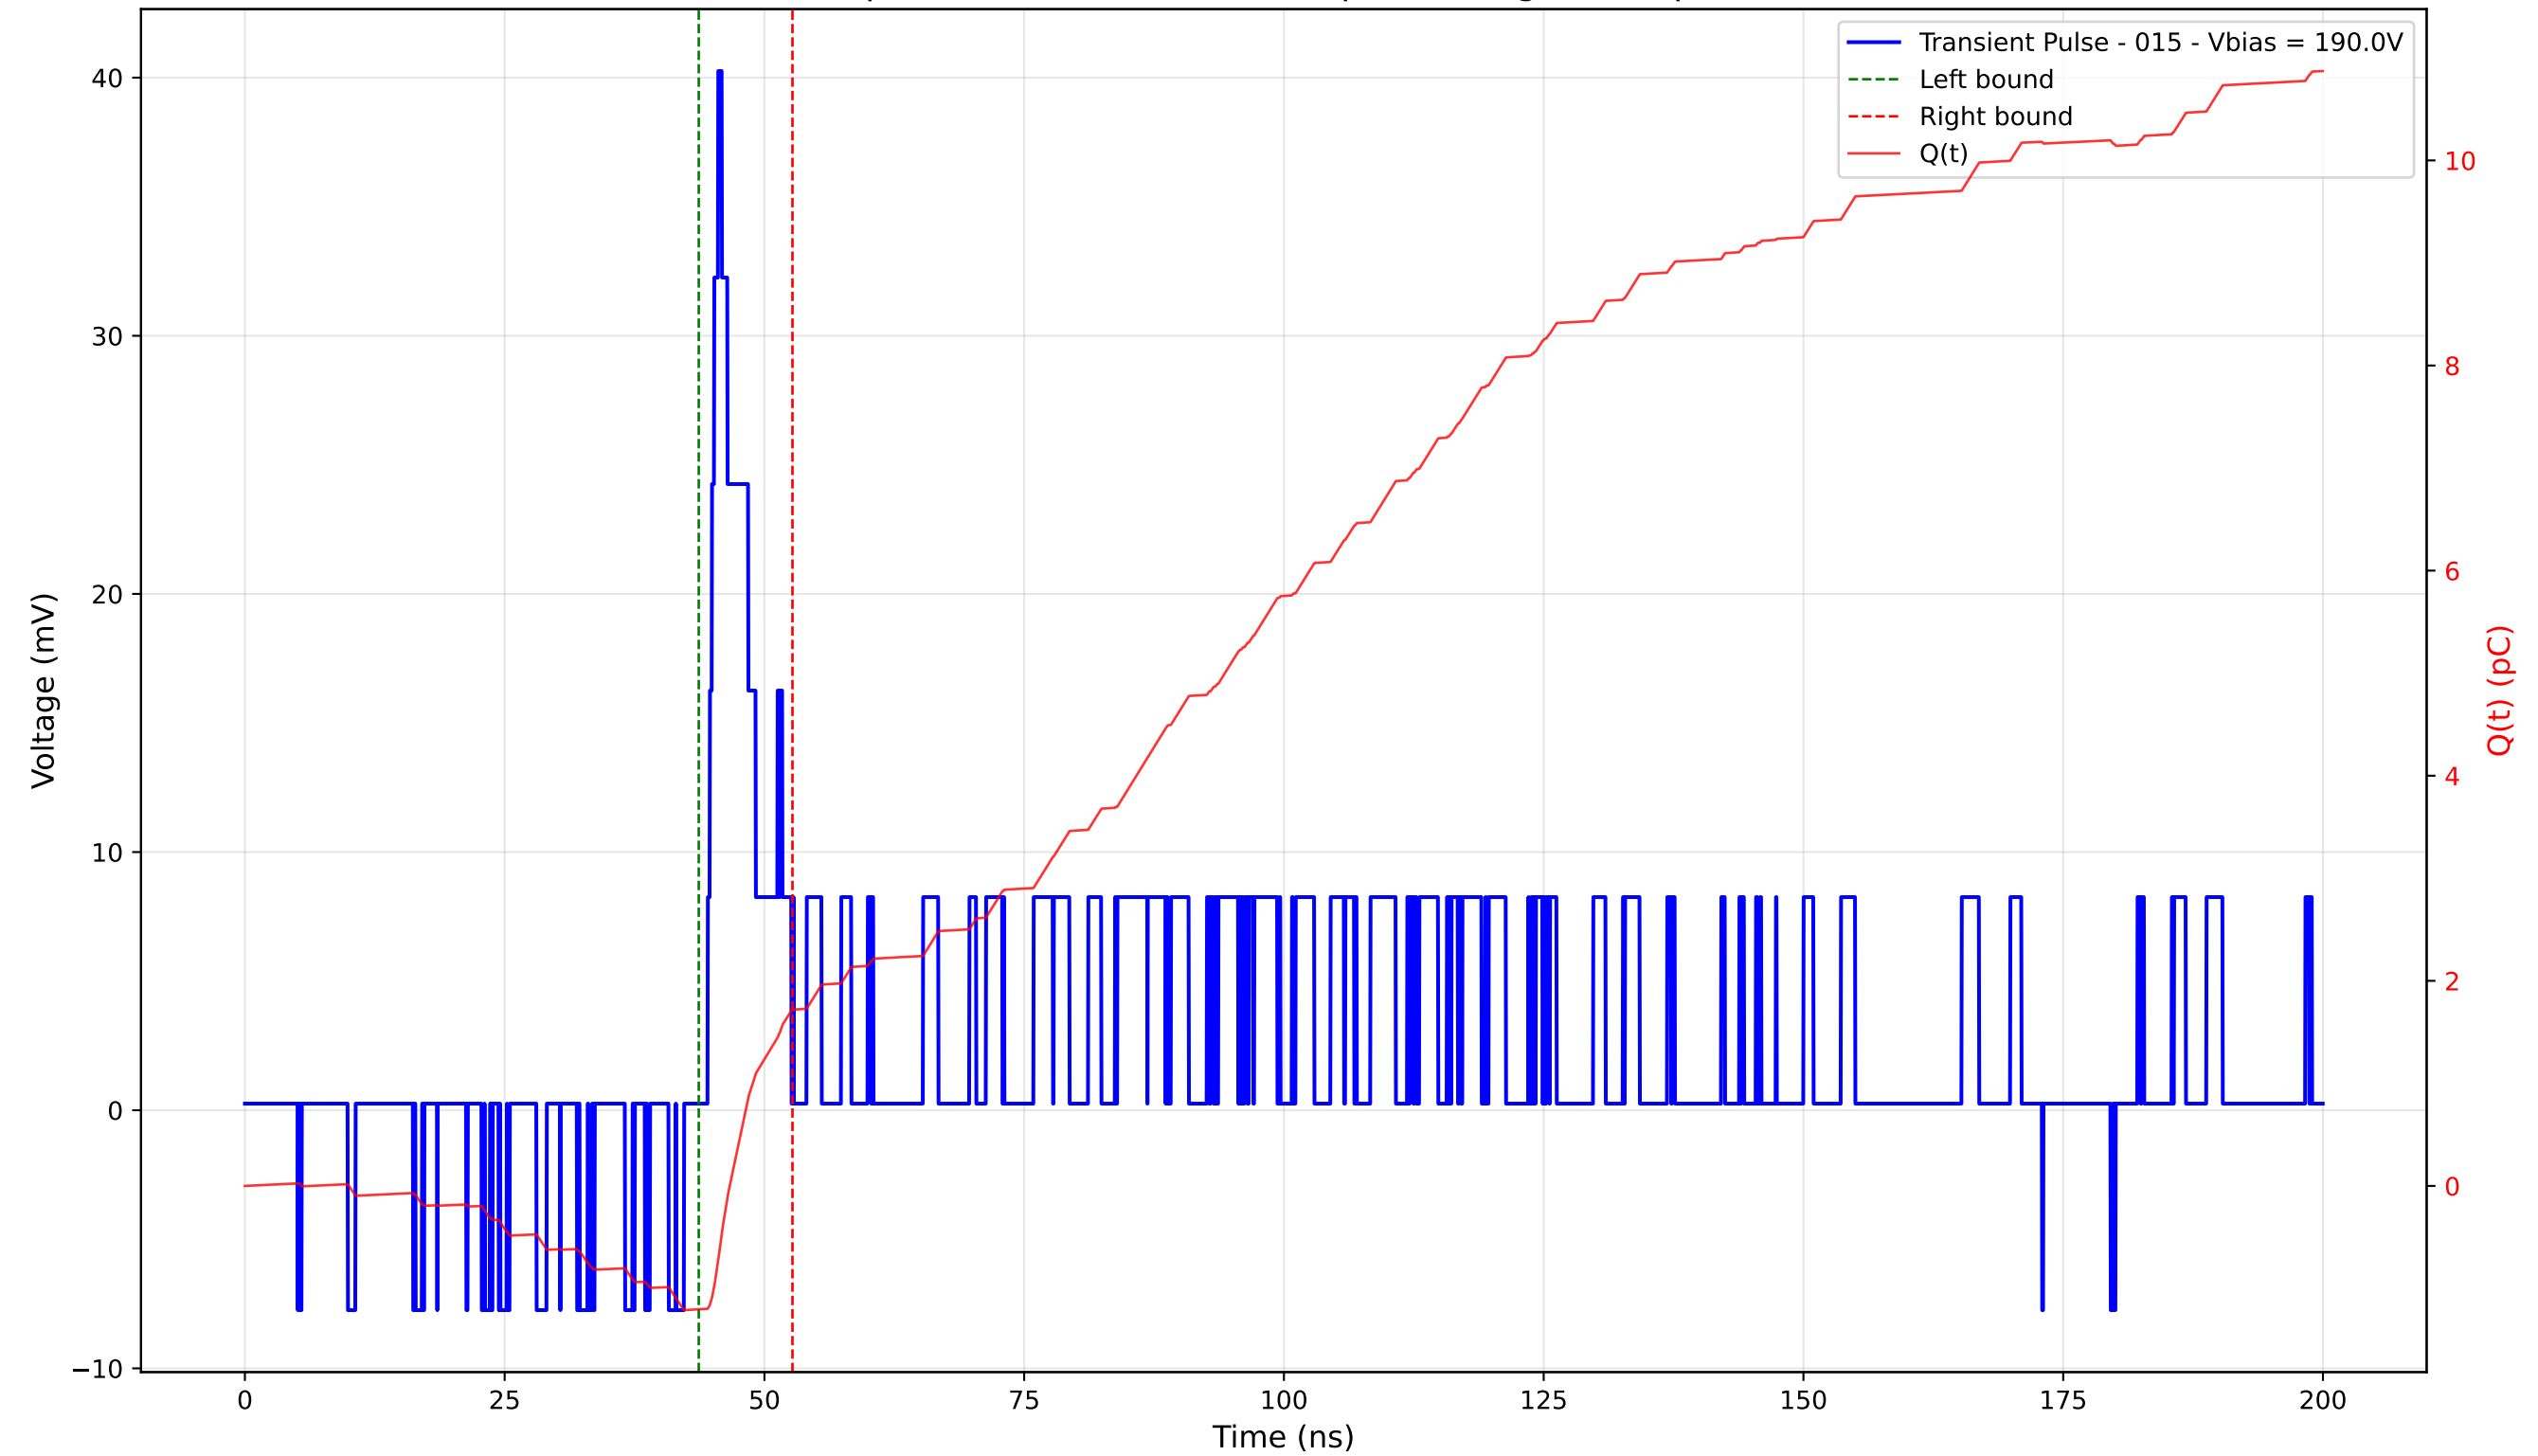


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 3.90 pC - Rise Time: 0.85 ns

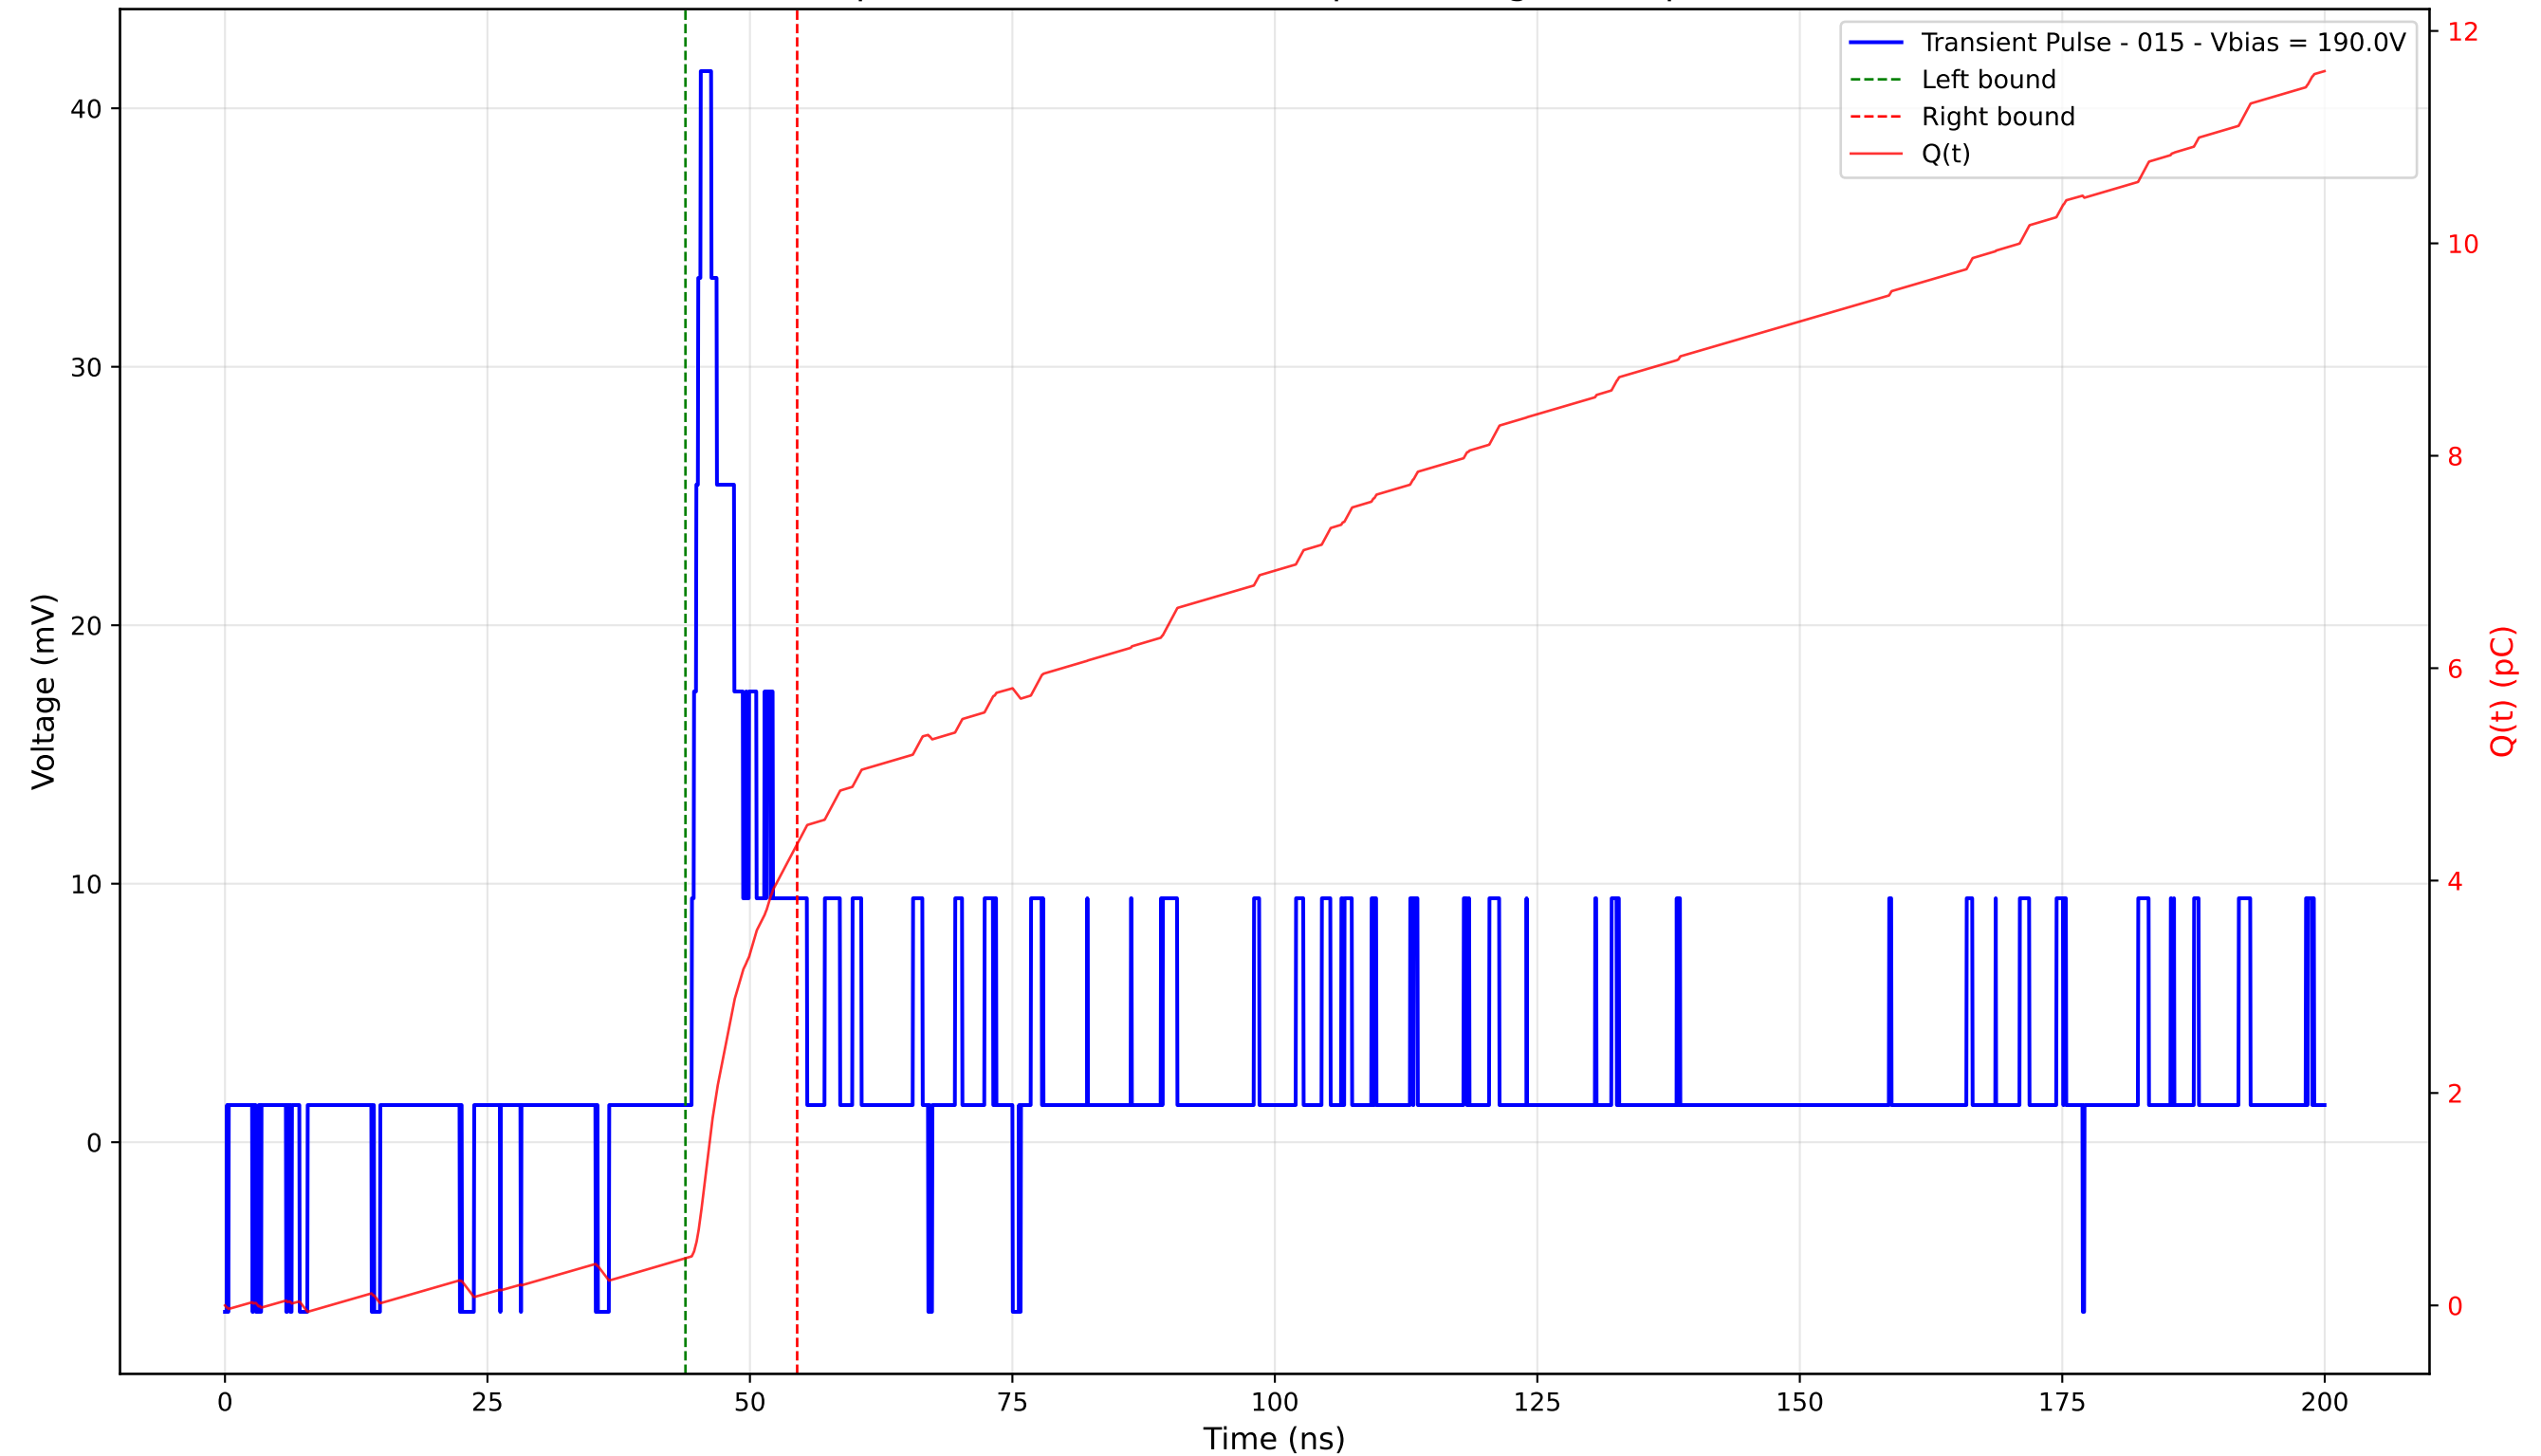


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 4.43 pC - Rise Time: 1.07 ns

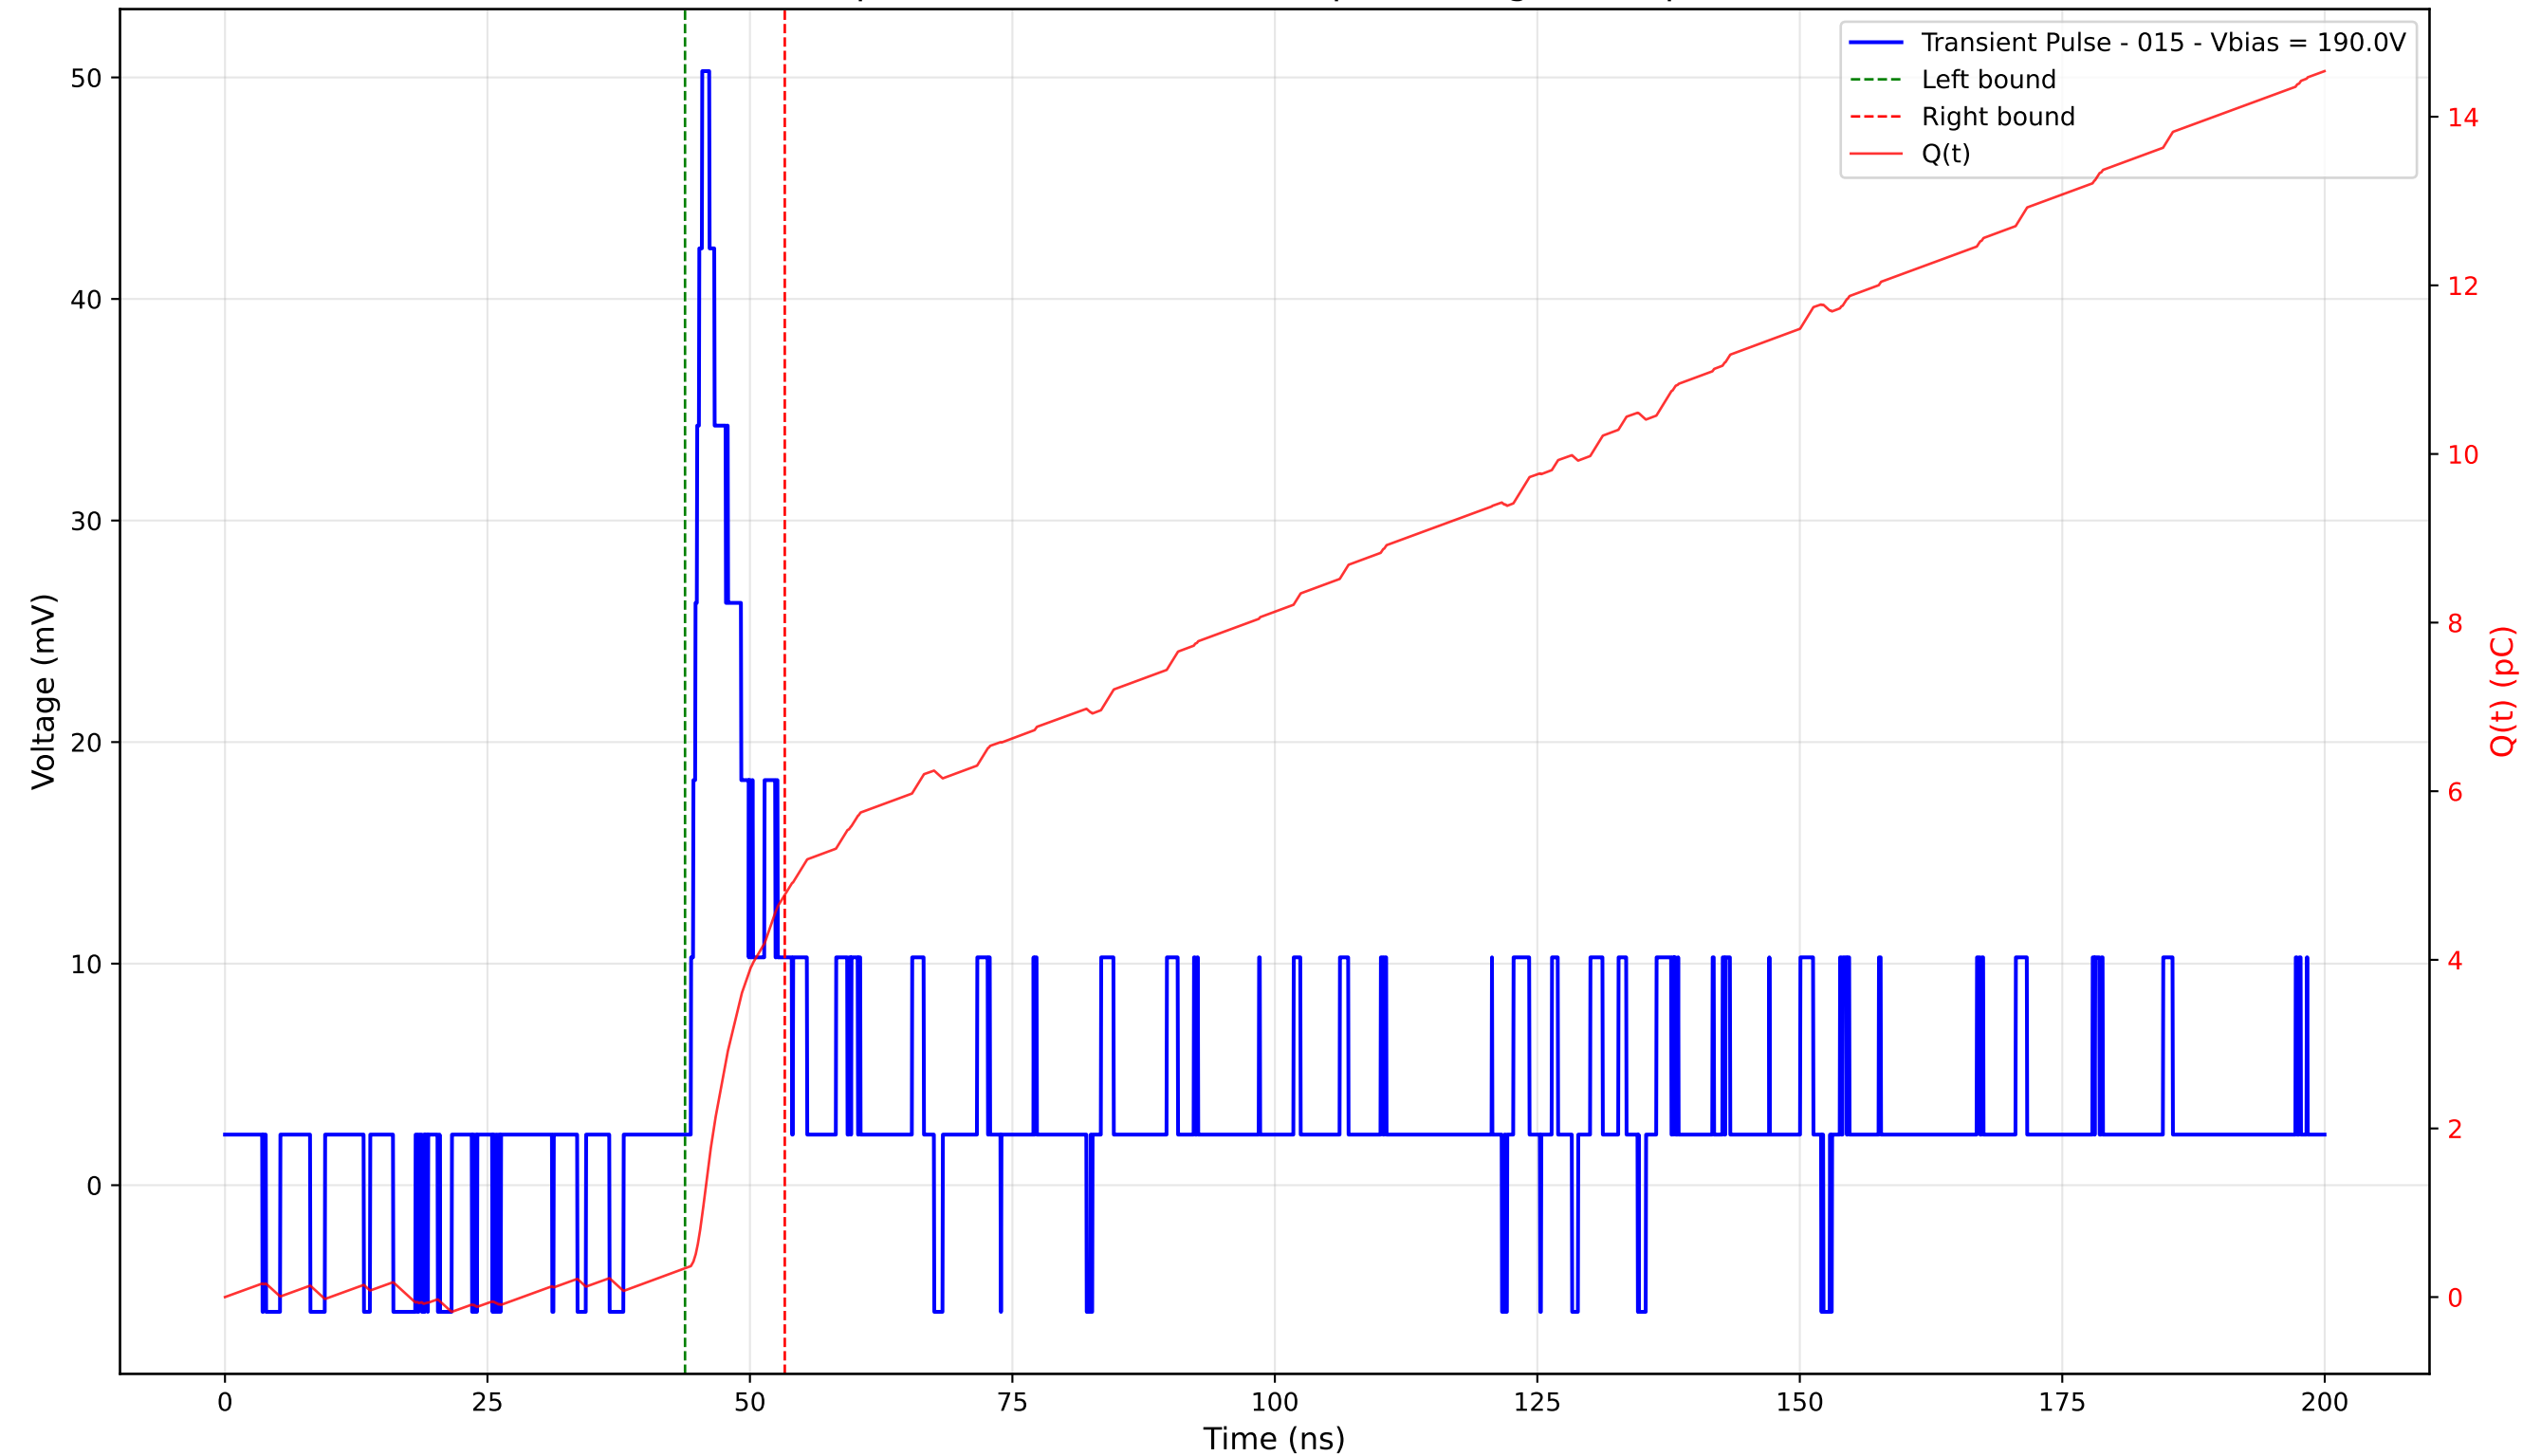


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 5.66 pC - Rise Time: 1.05 ns

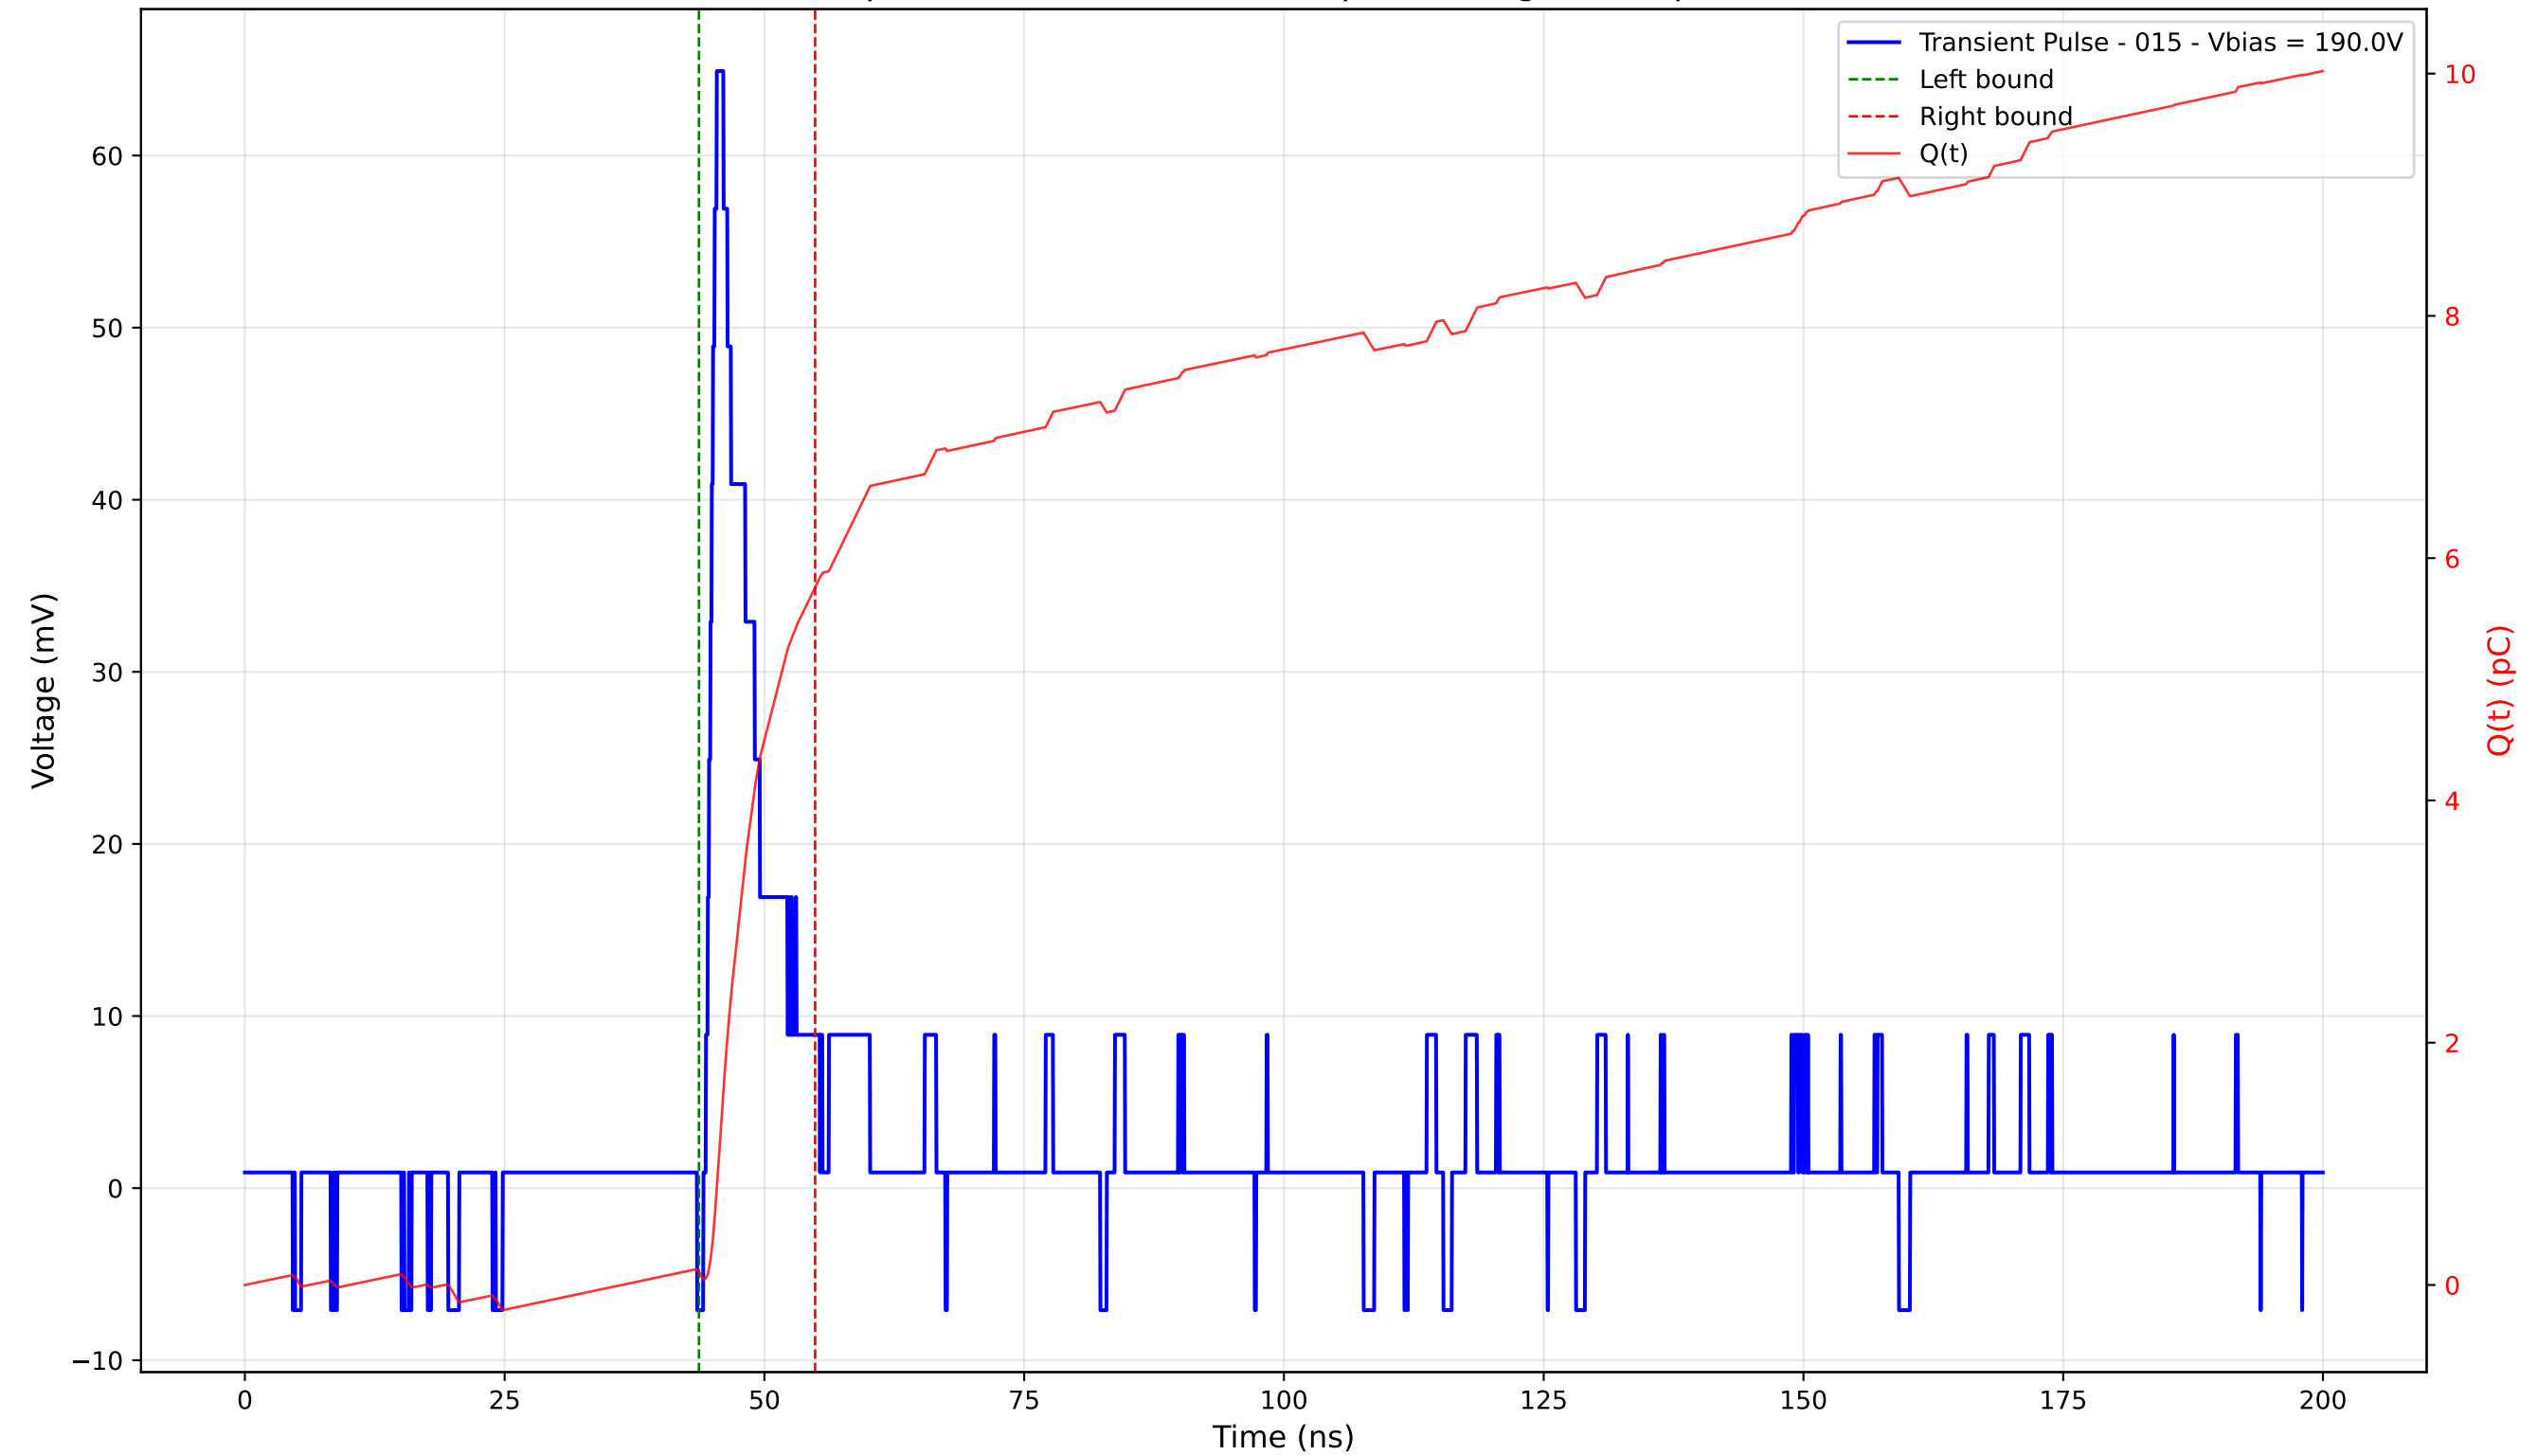


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 5.85 pC - Rise Time: 0.97 ns

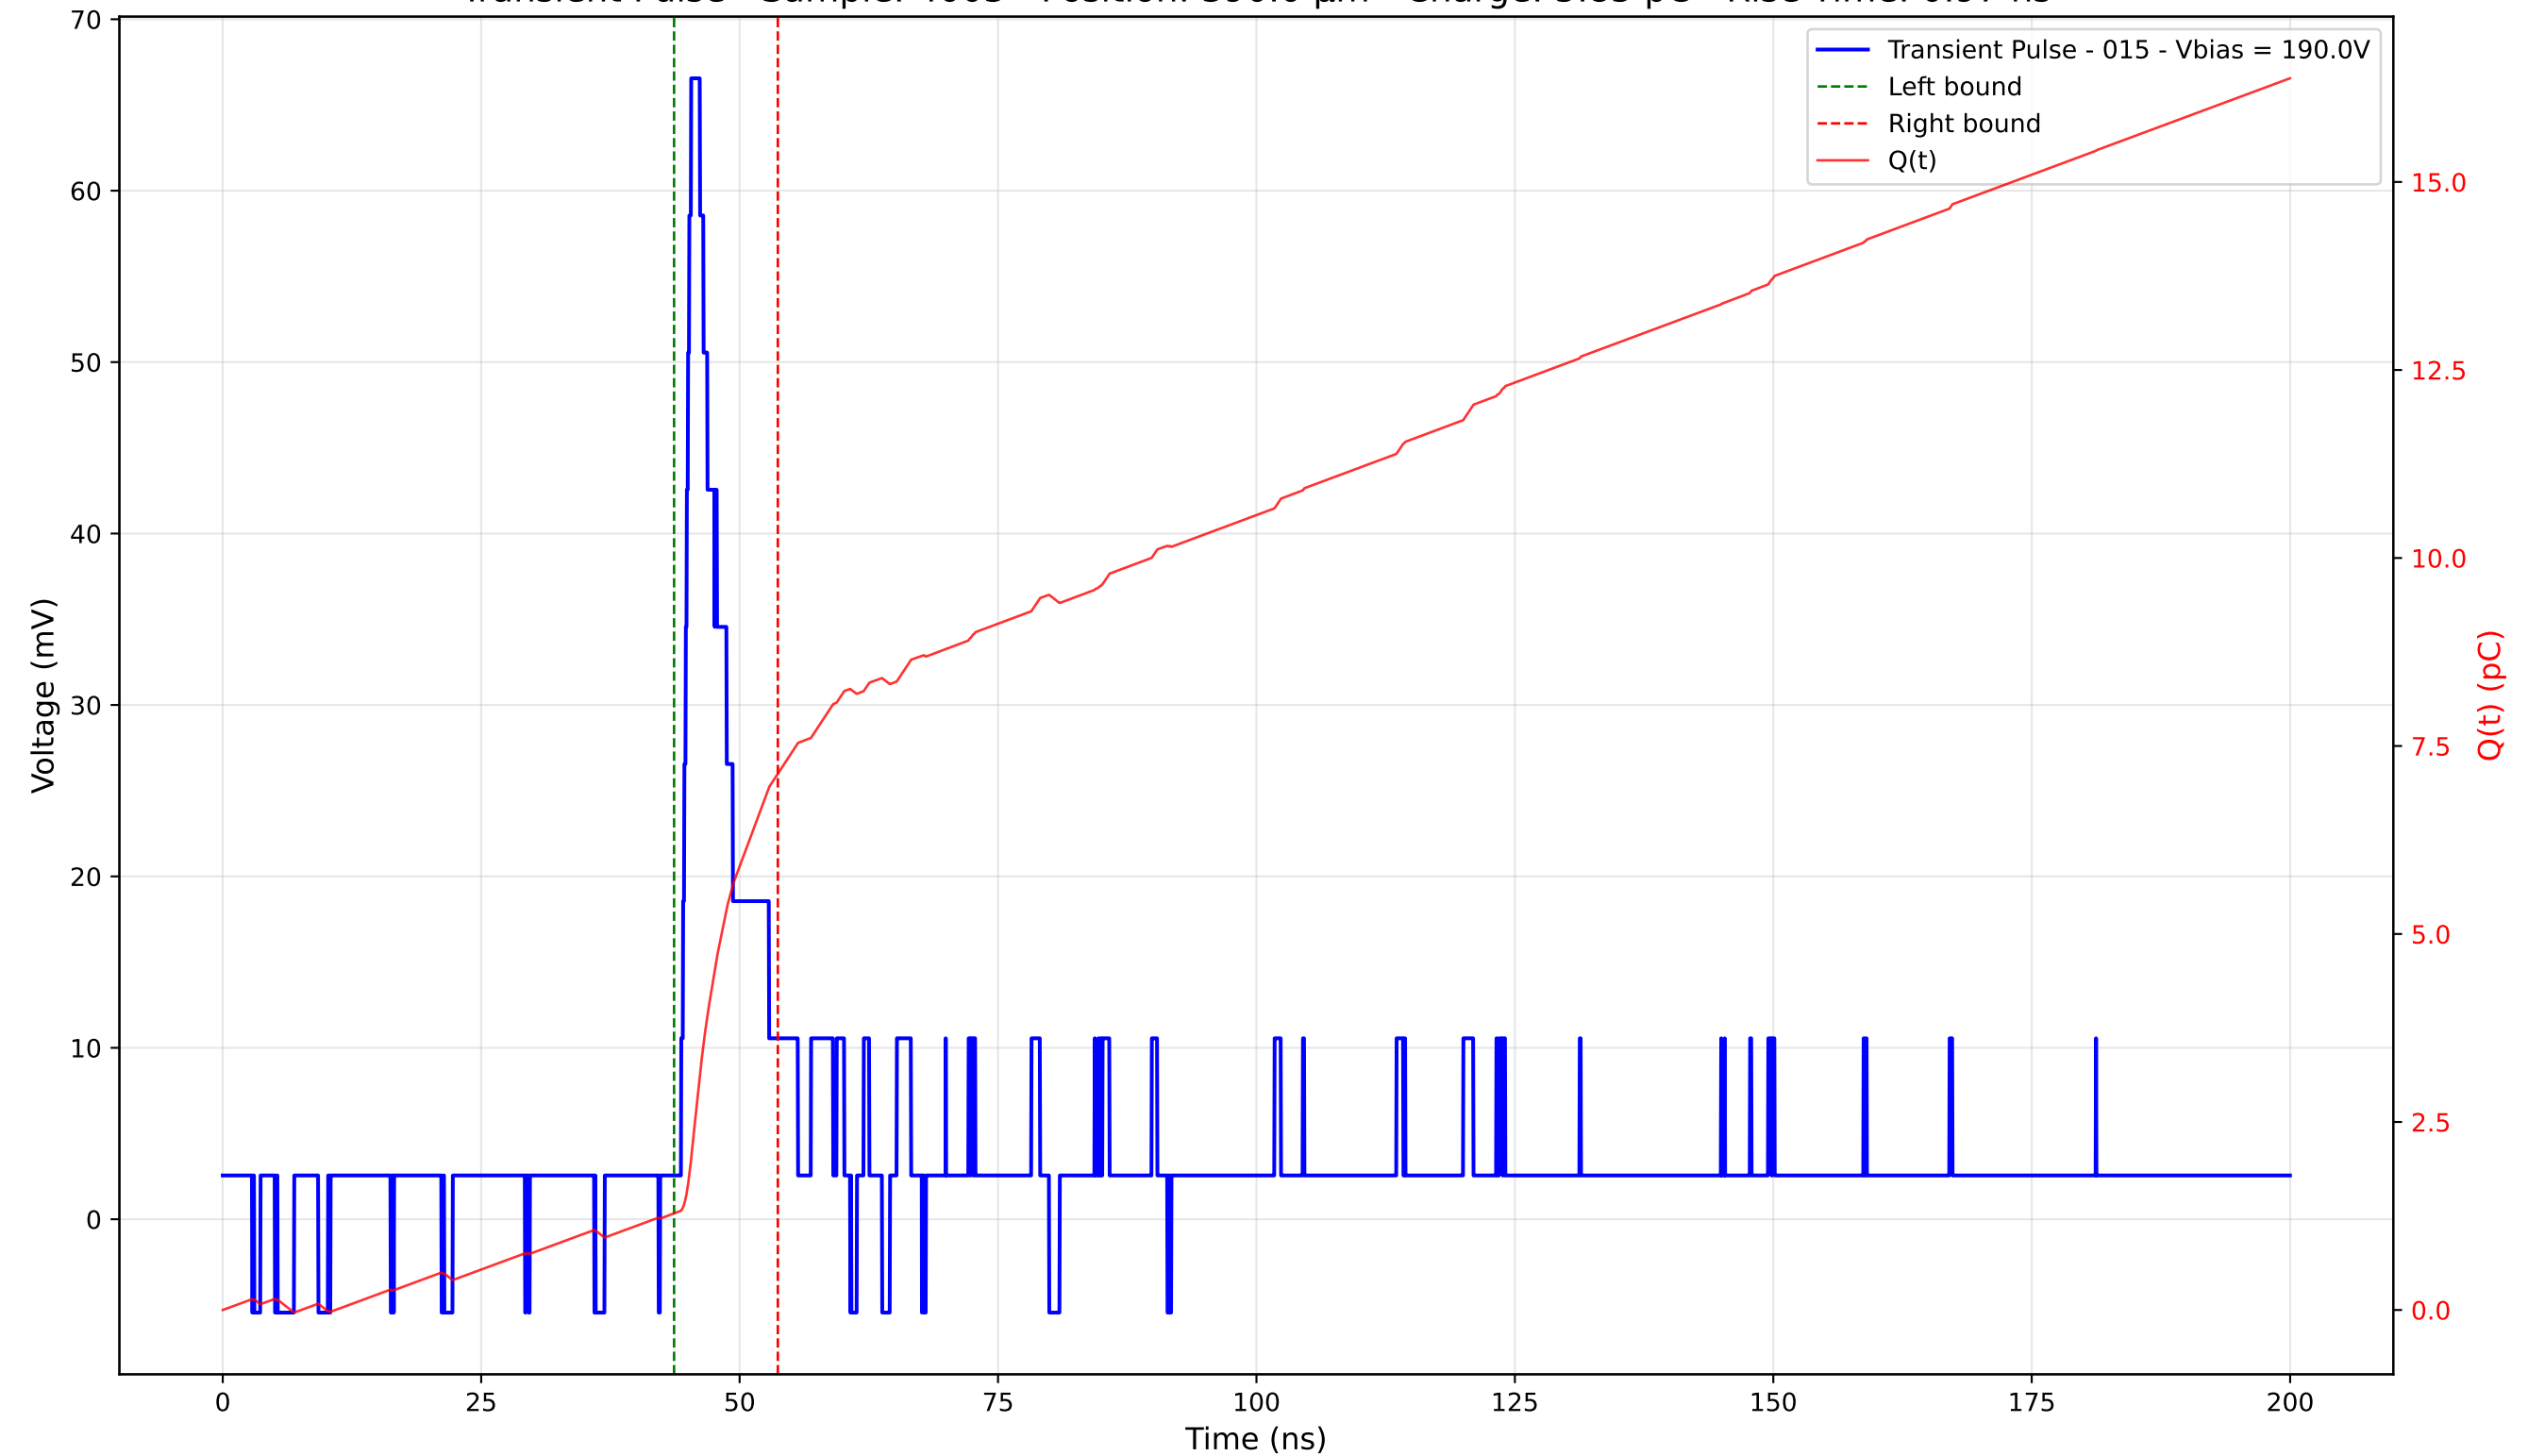


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 5.56 pC - Rise Time: 1.16 ns

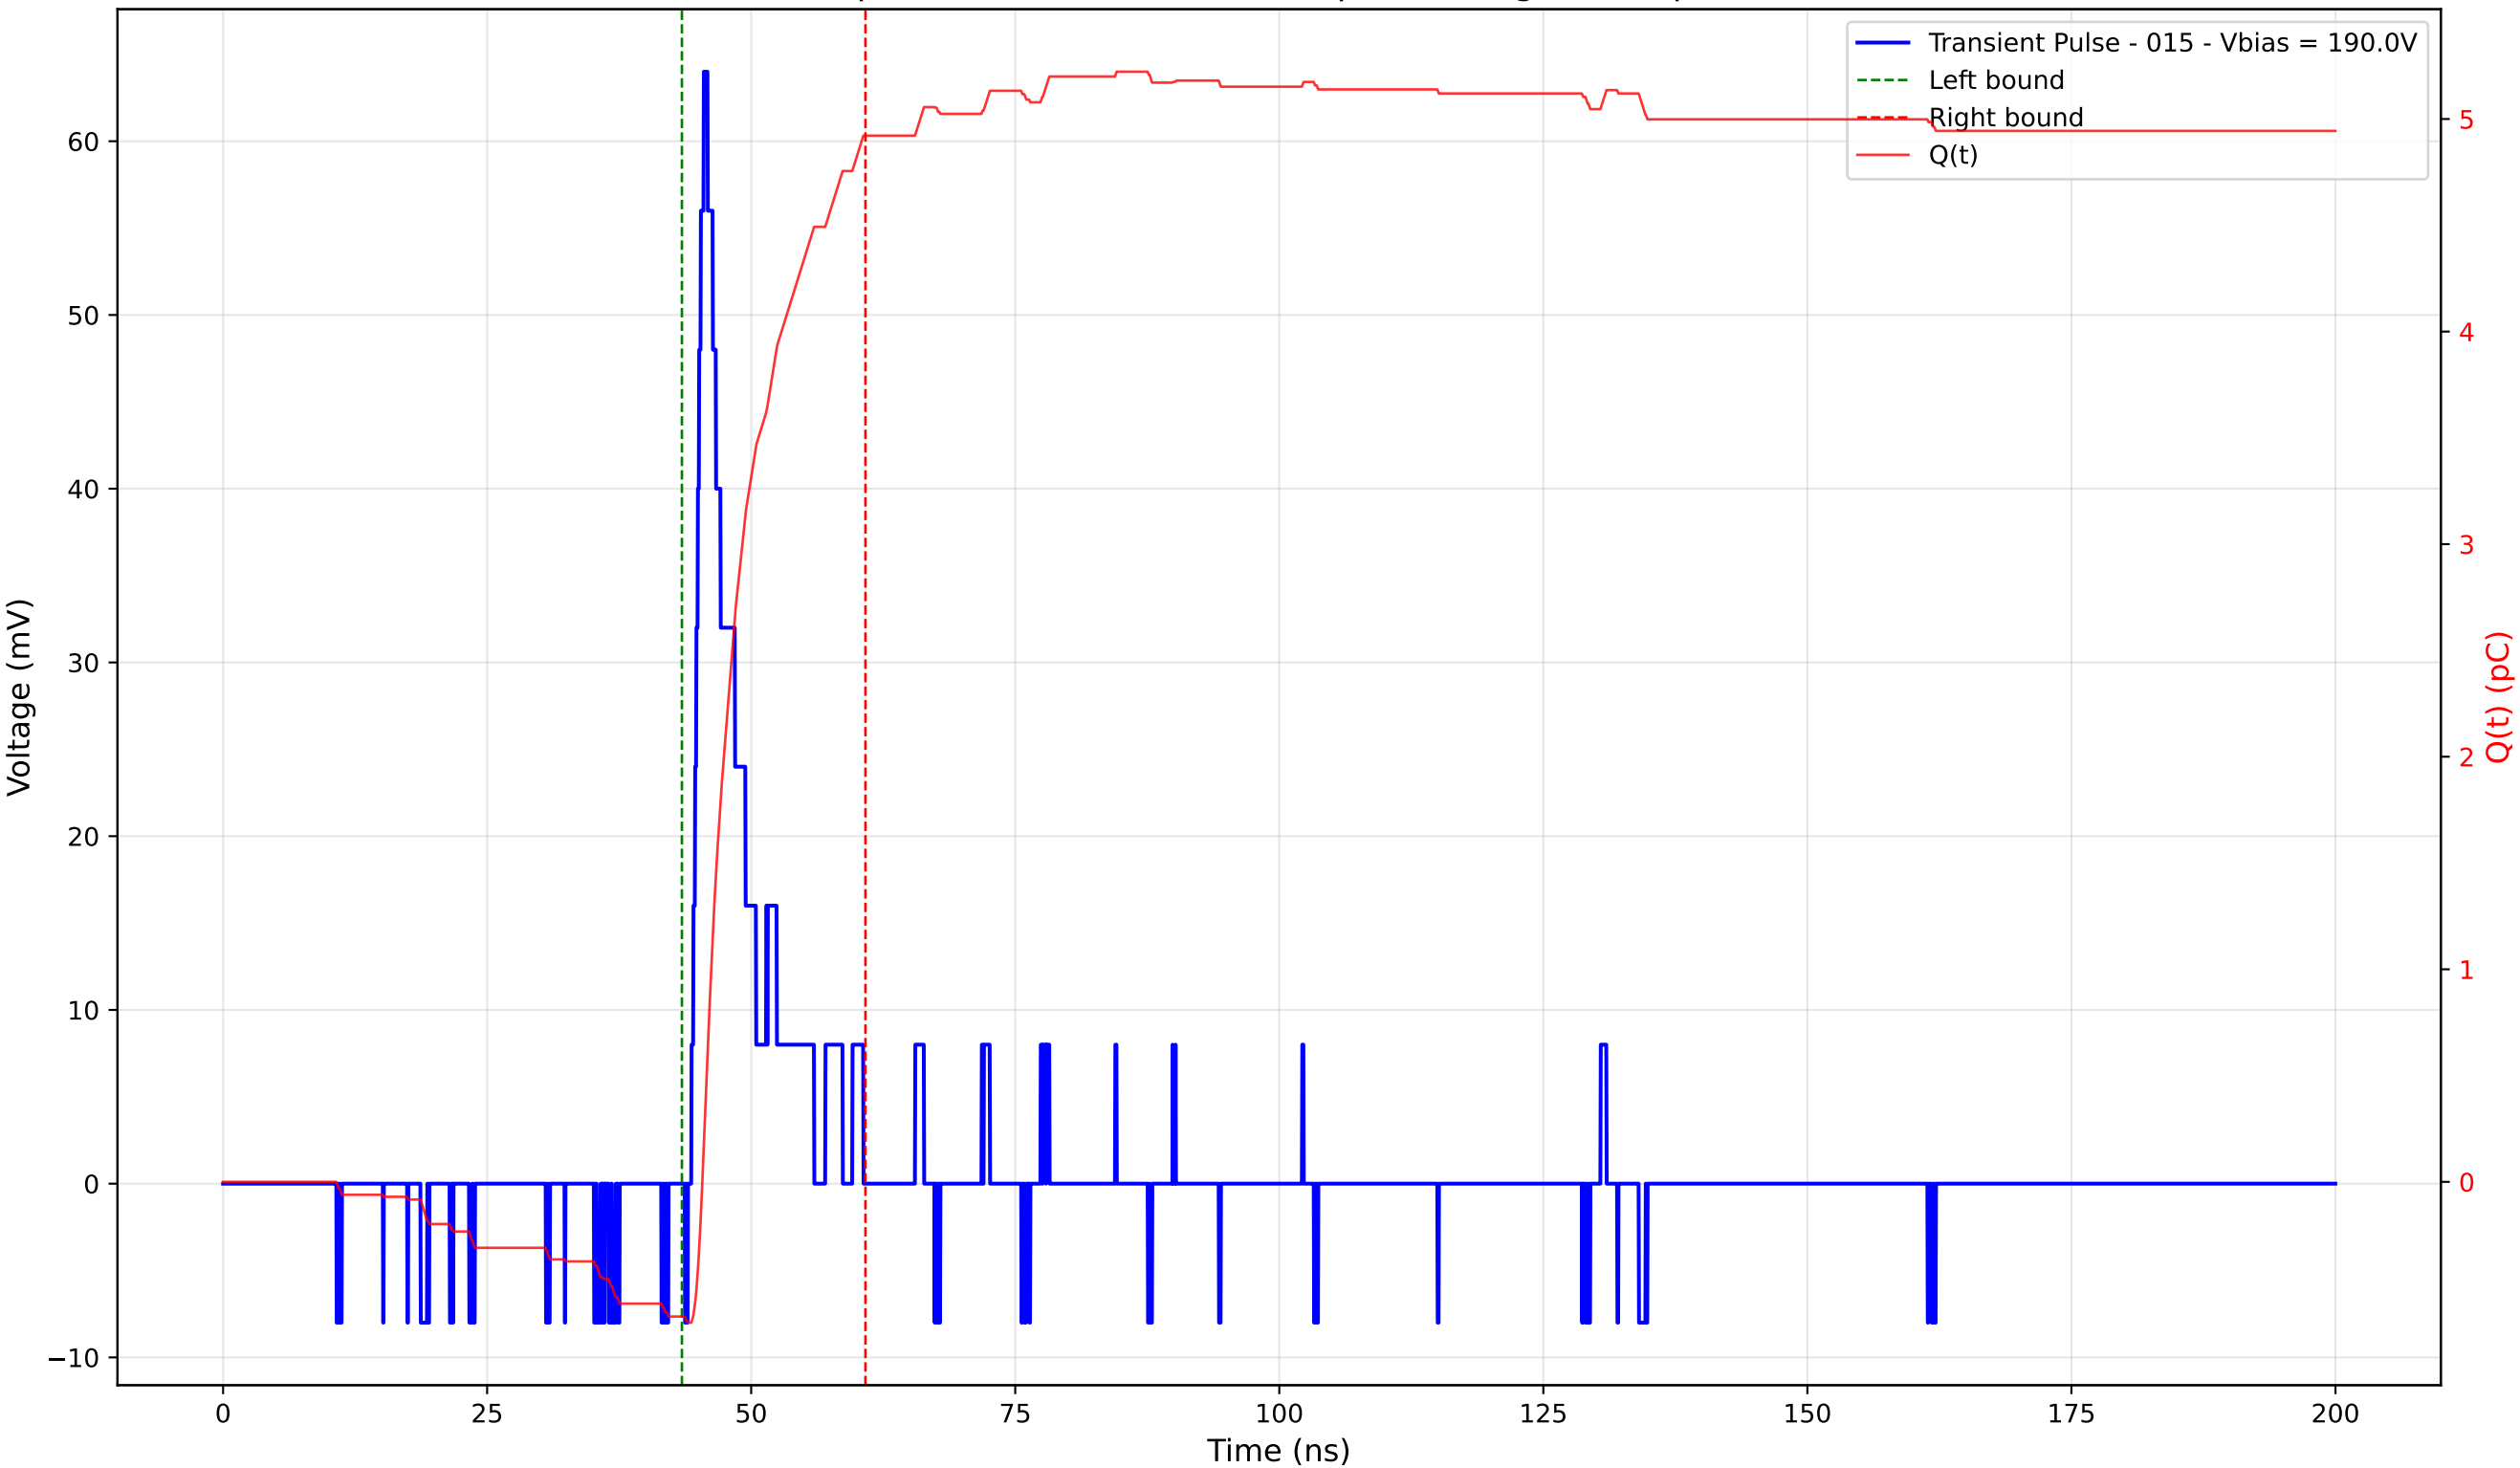


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 4.73 pC - Rise Time: 0.95 ns

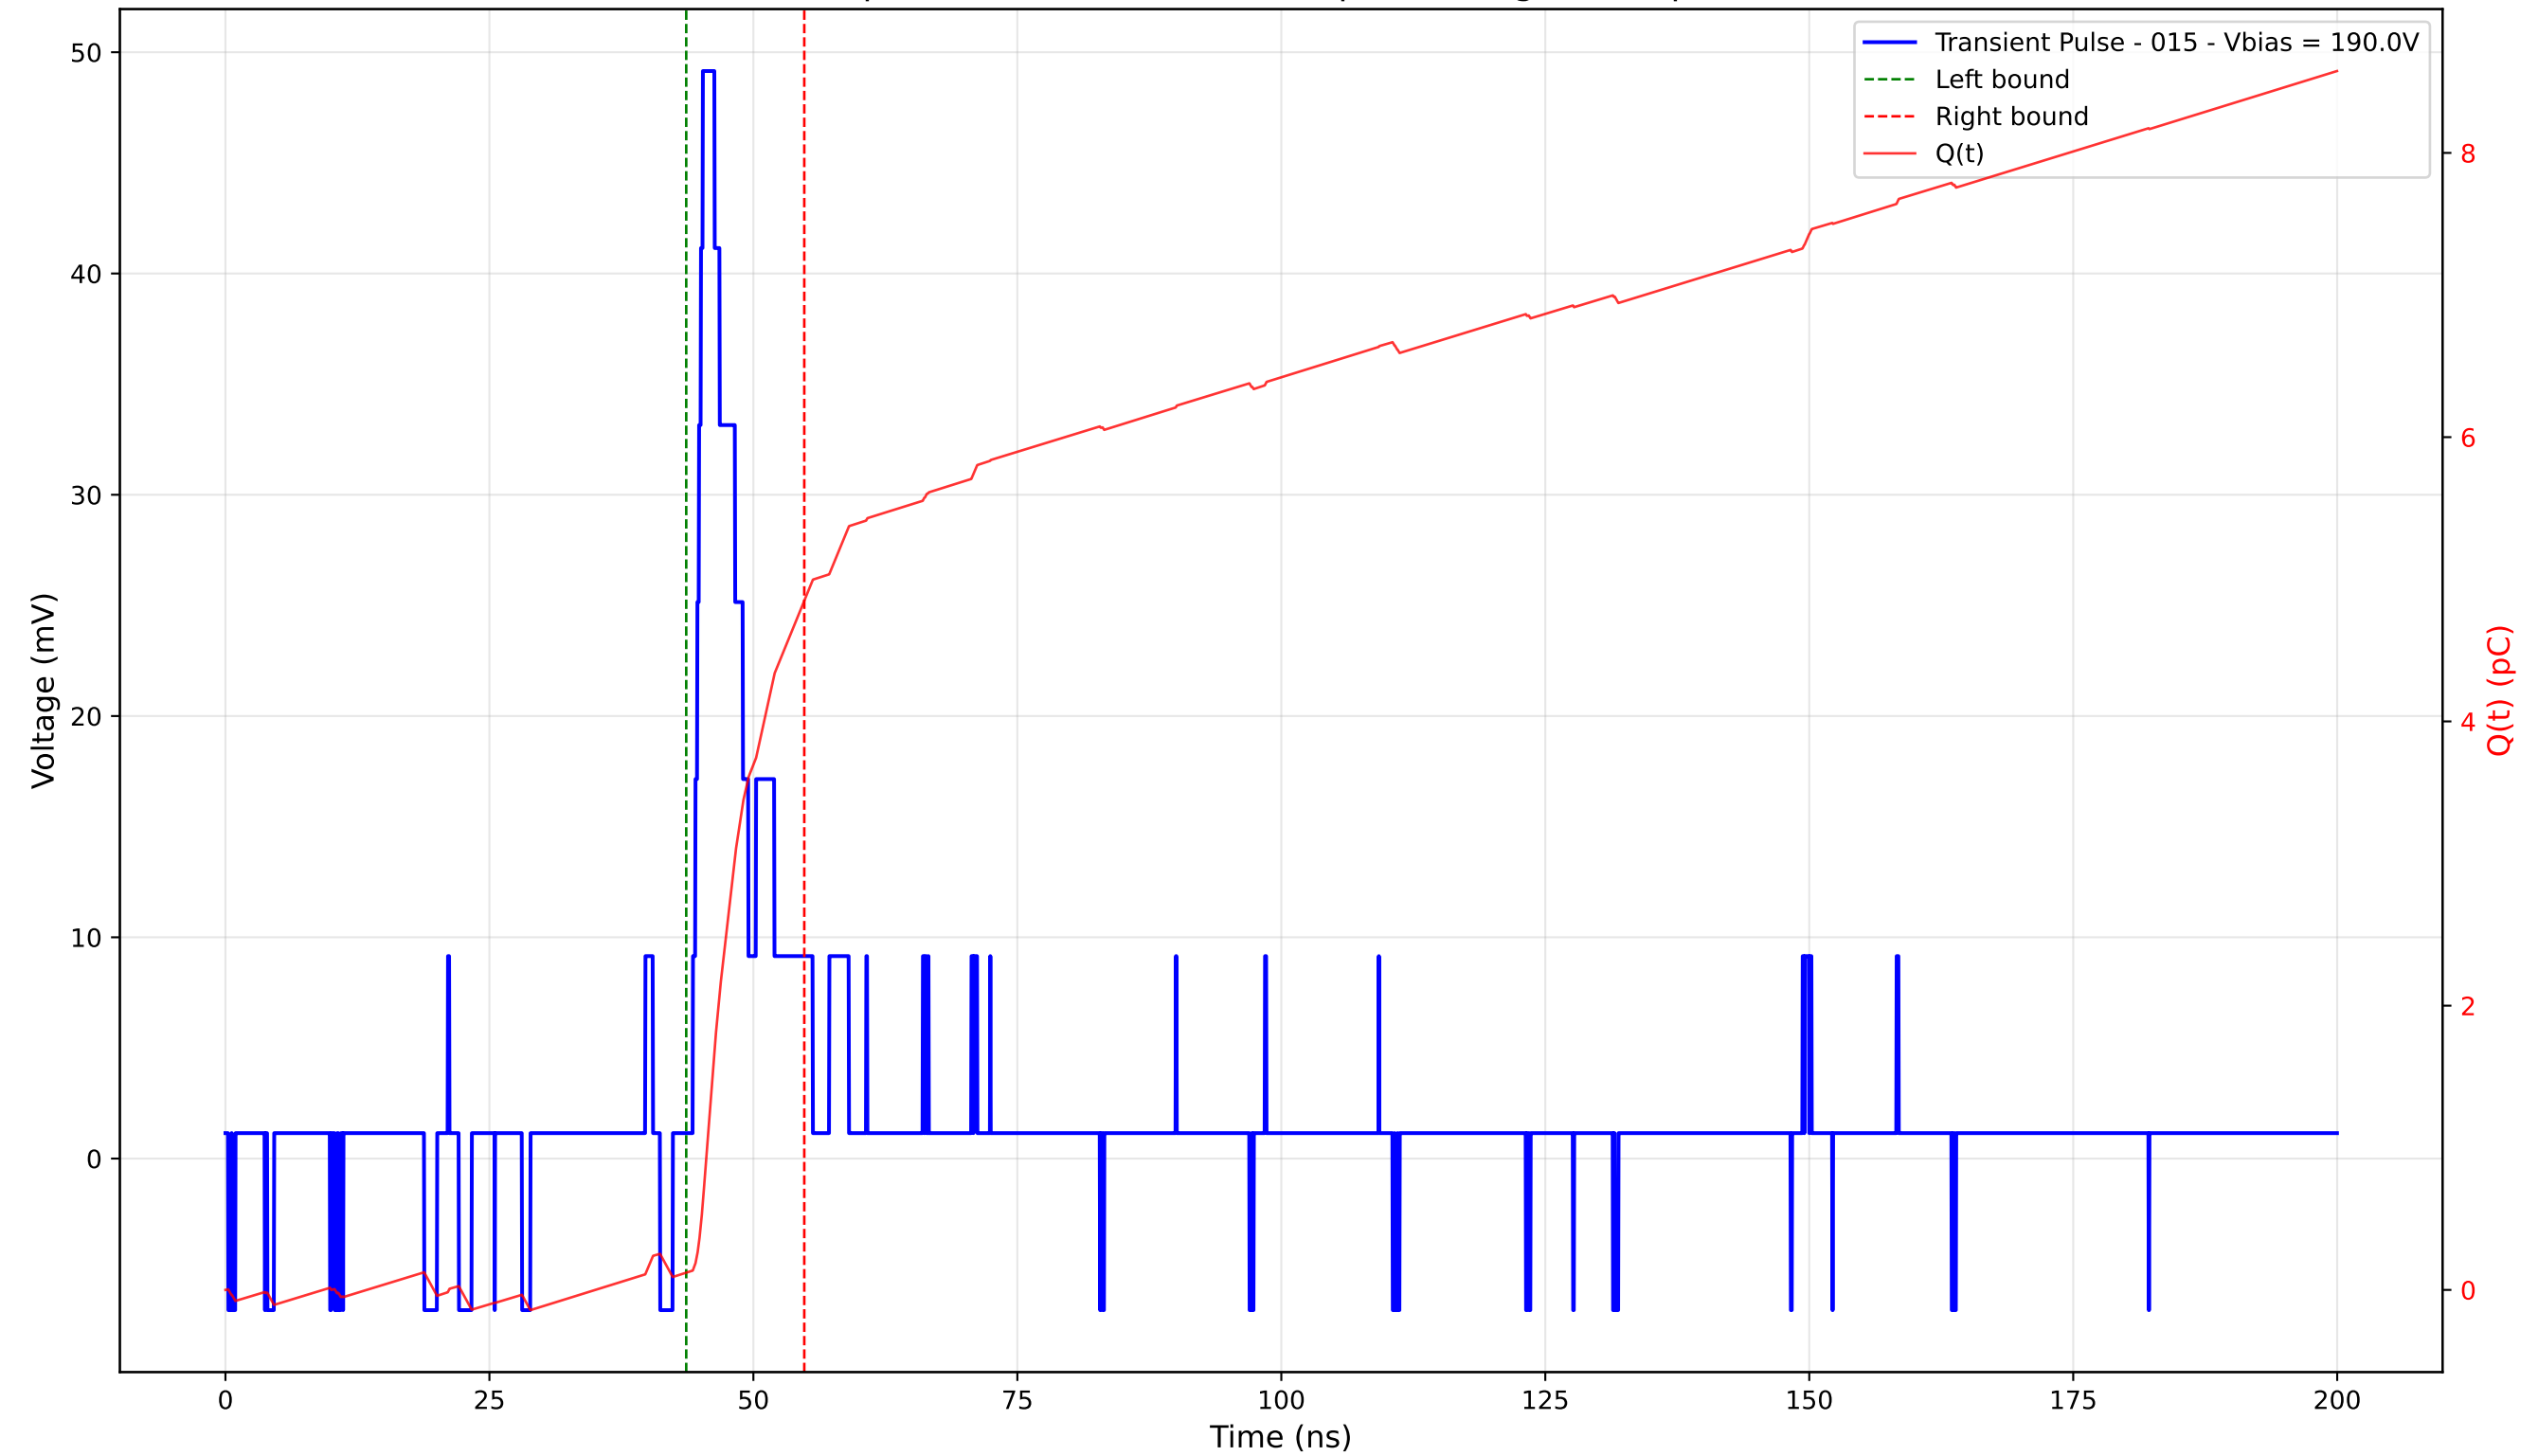


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 3.66 pC - Rise Time: 1.29 ns

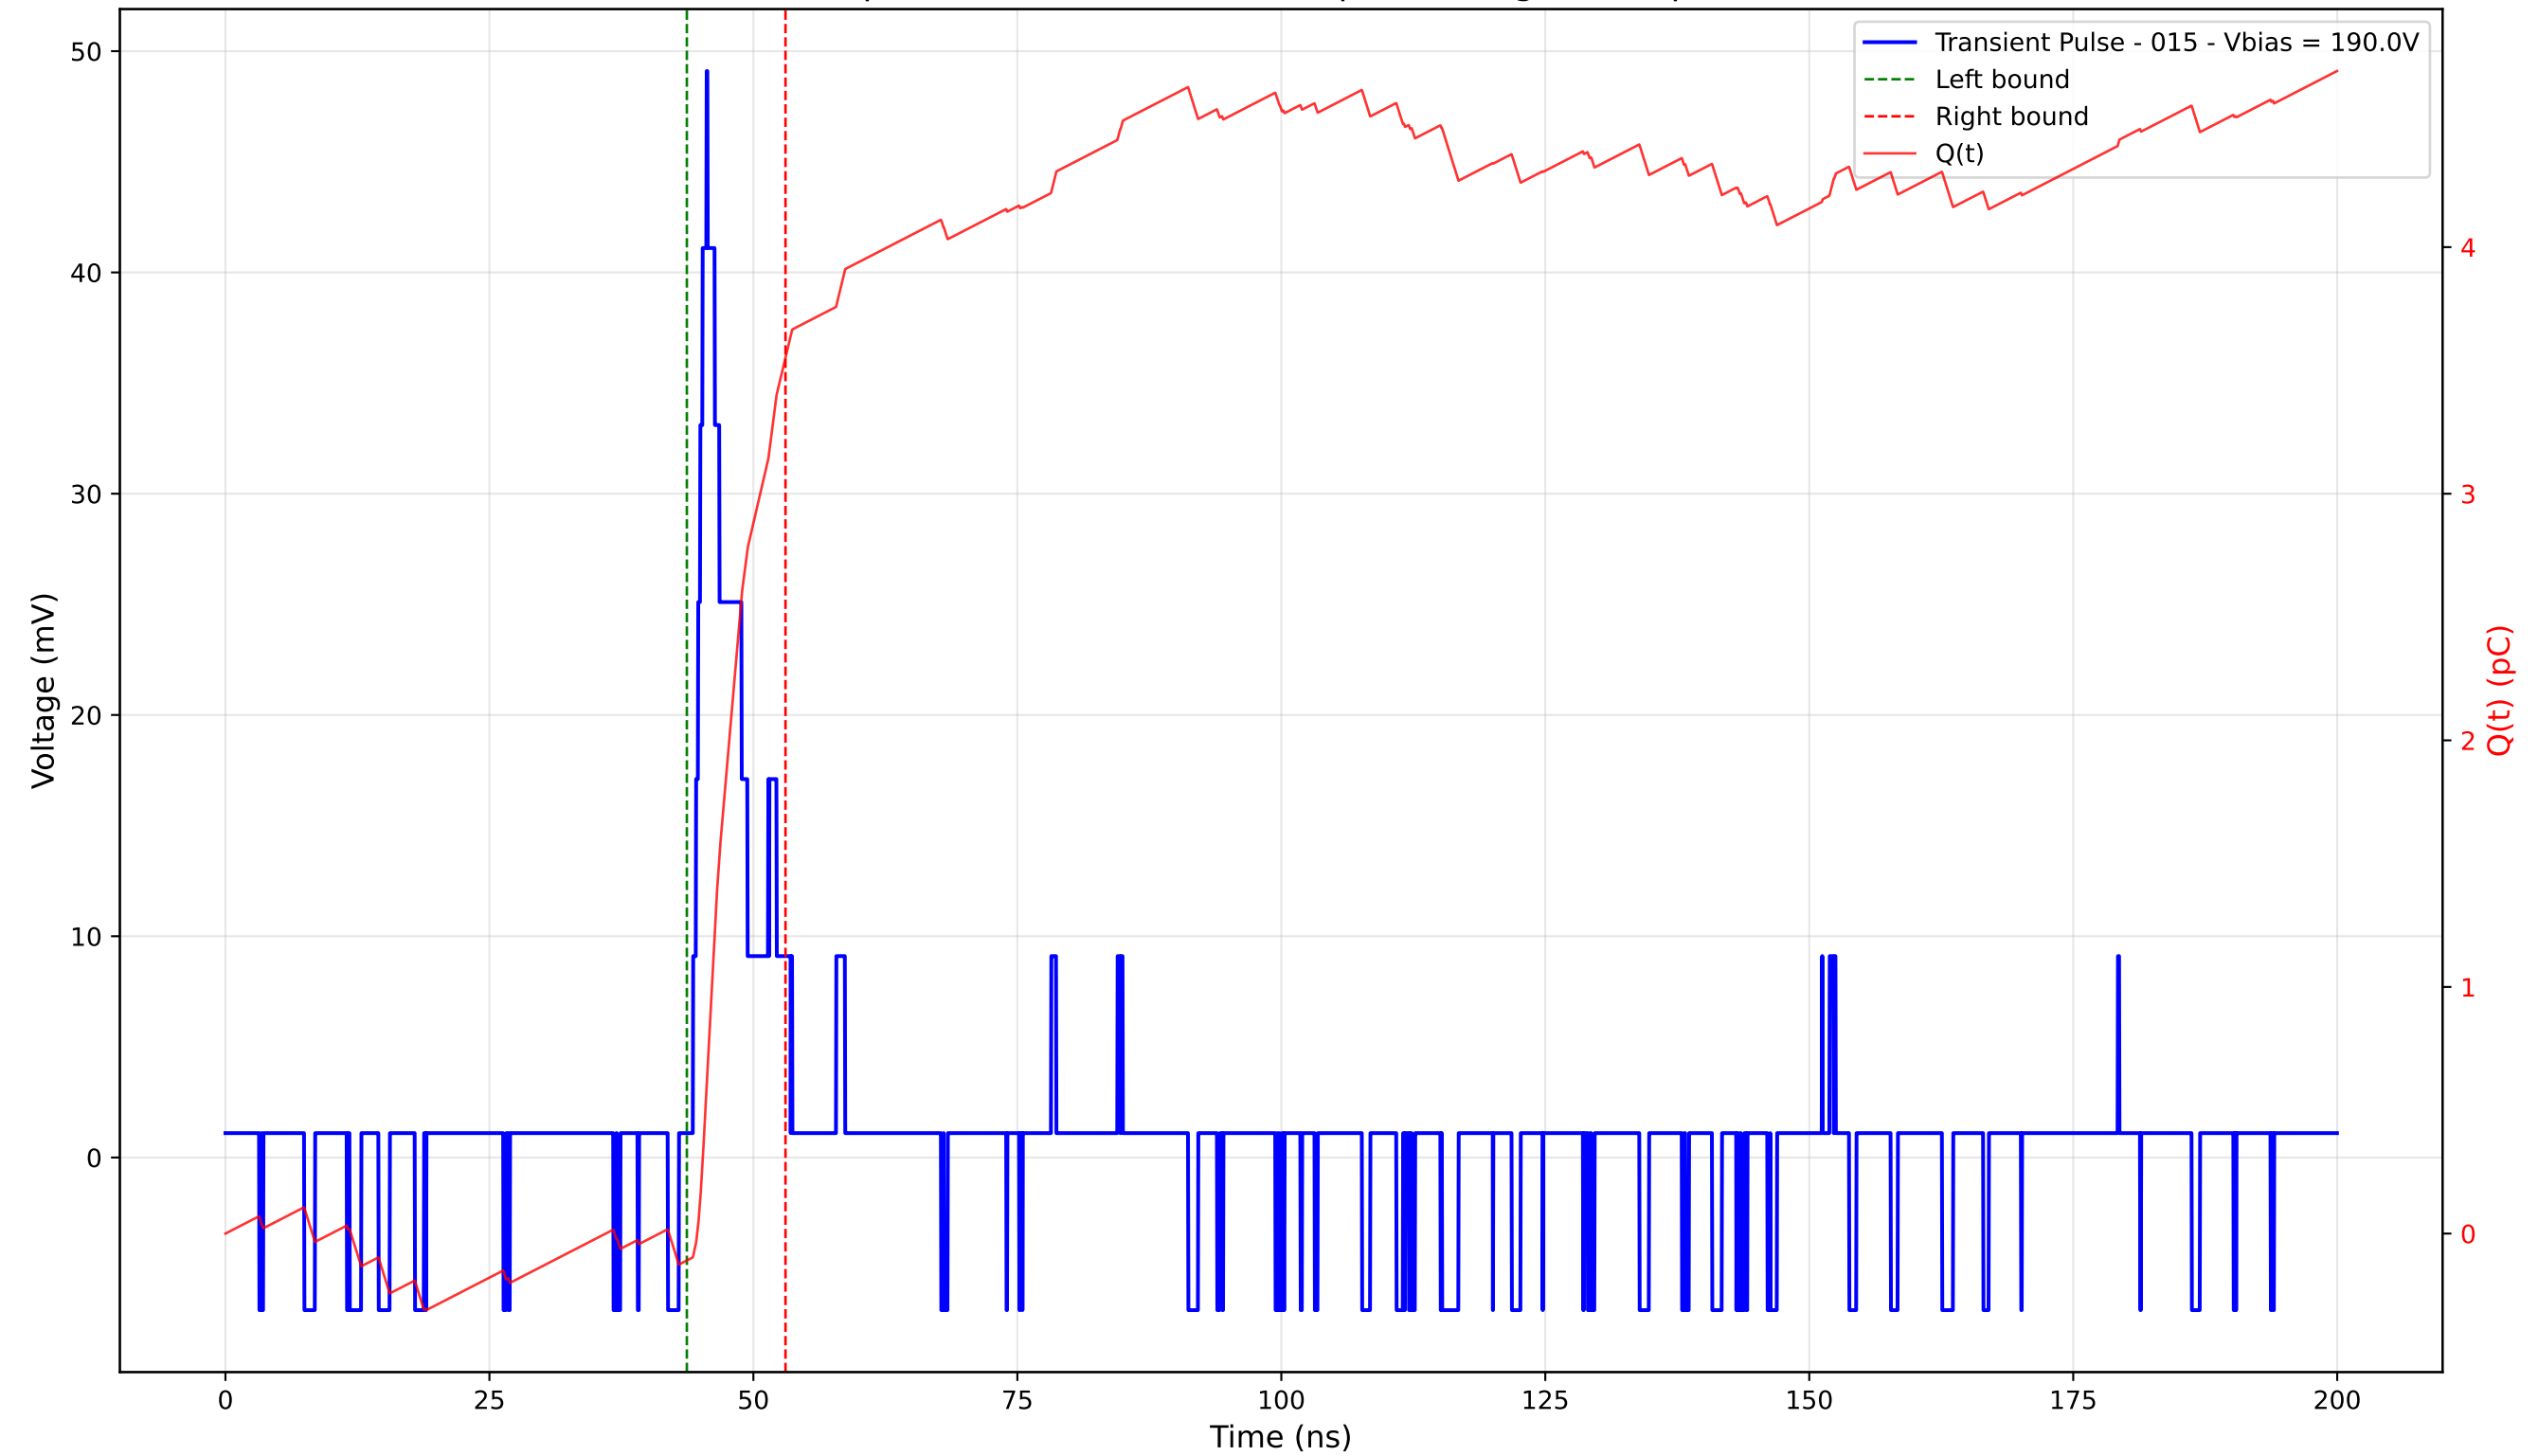


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 2.19 pC - Rise Time: 0.72 ns

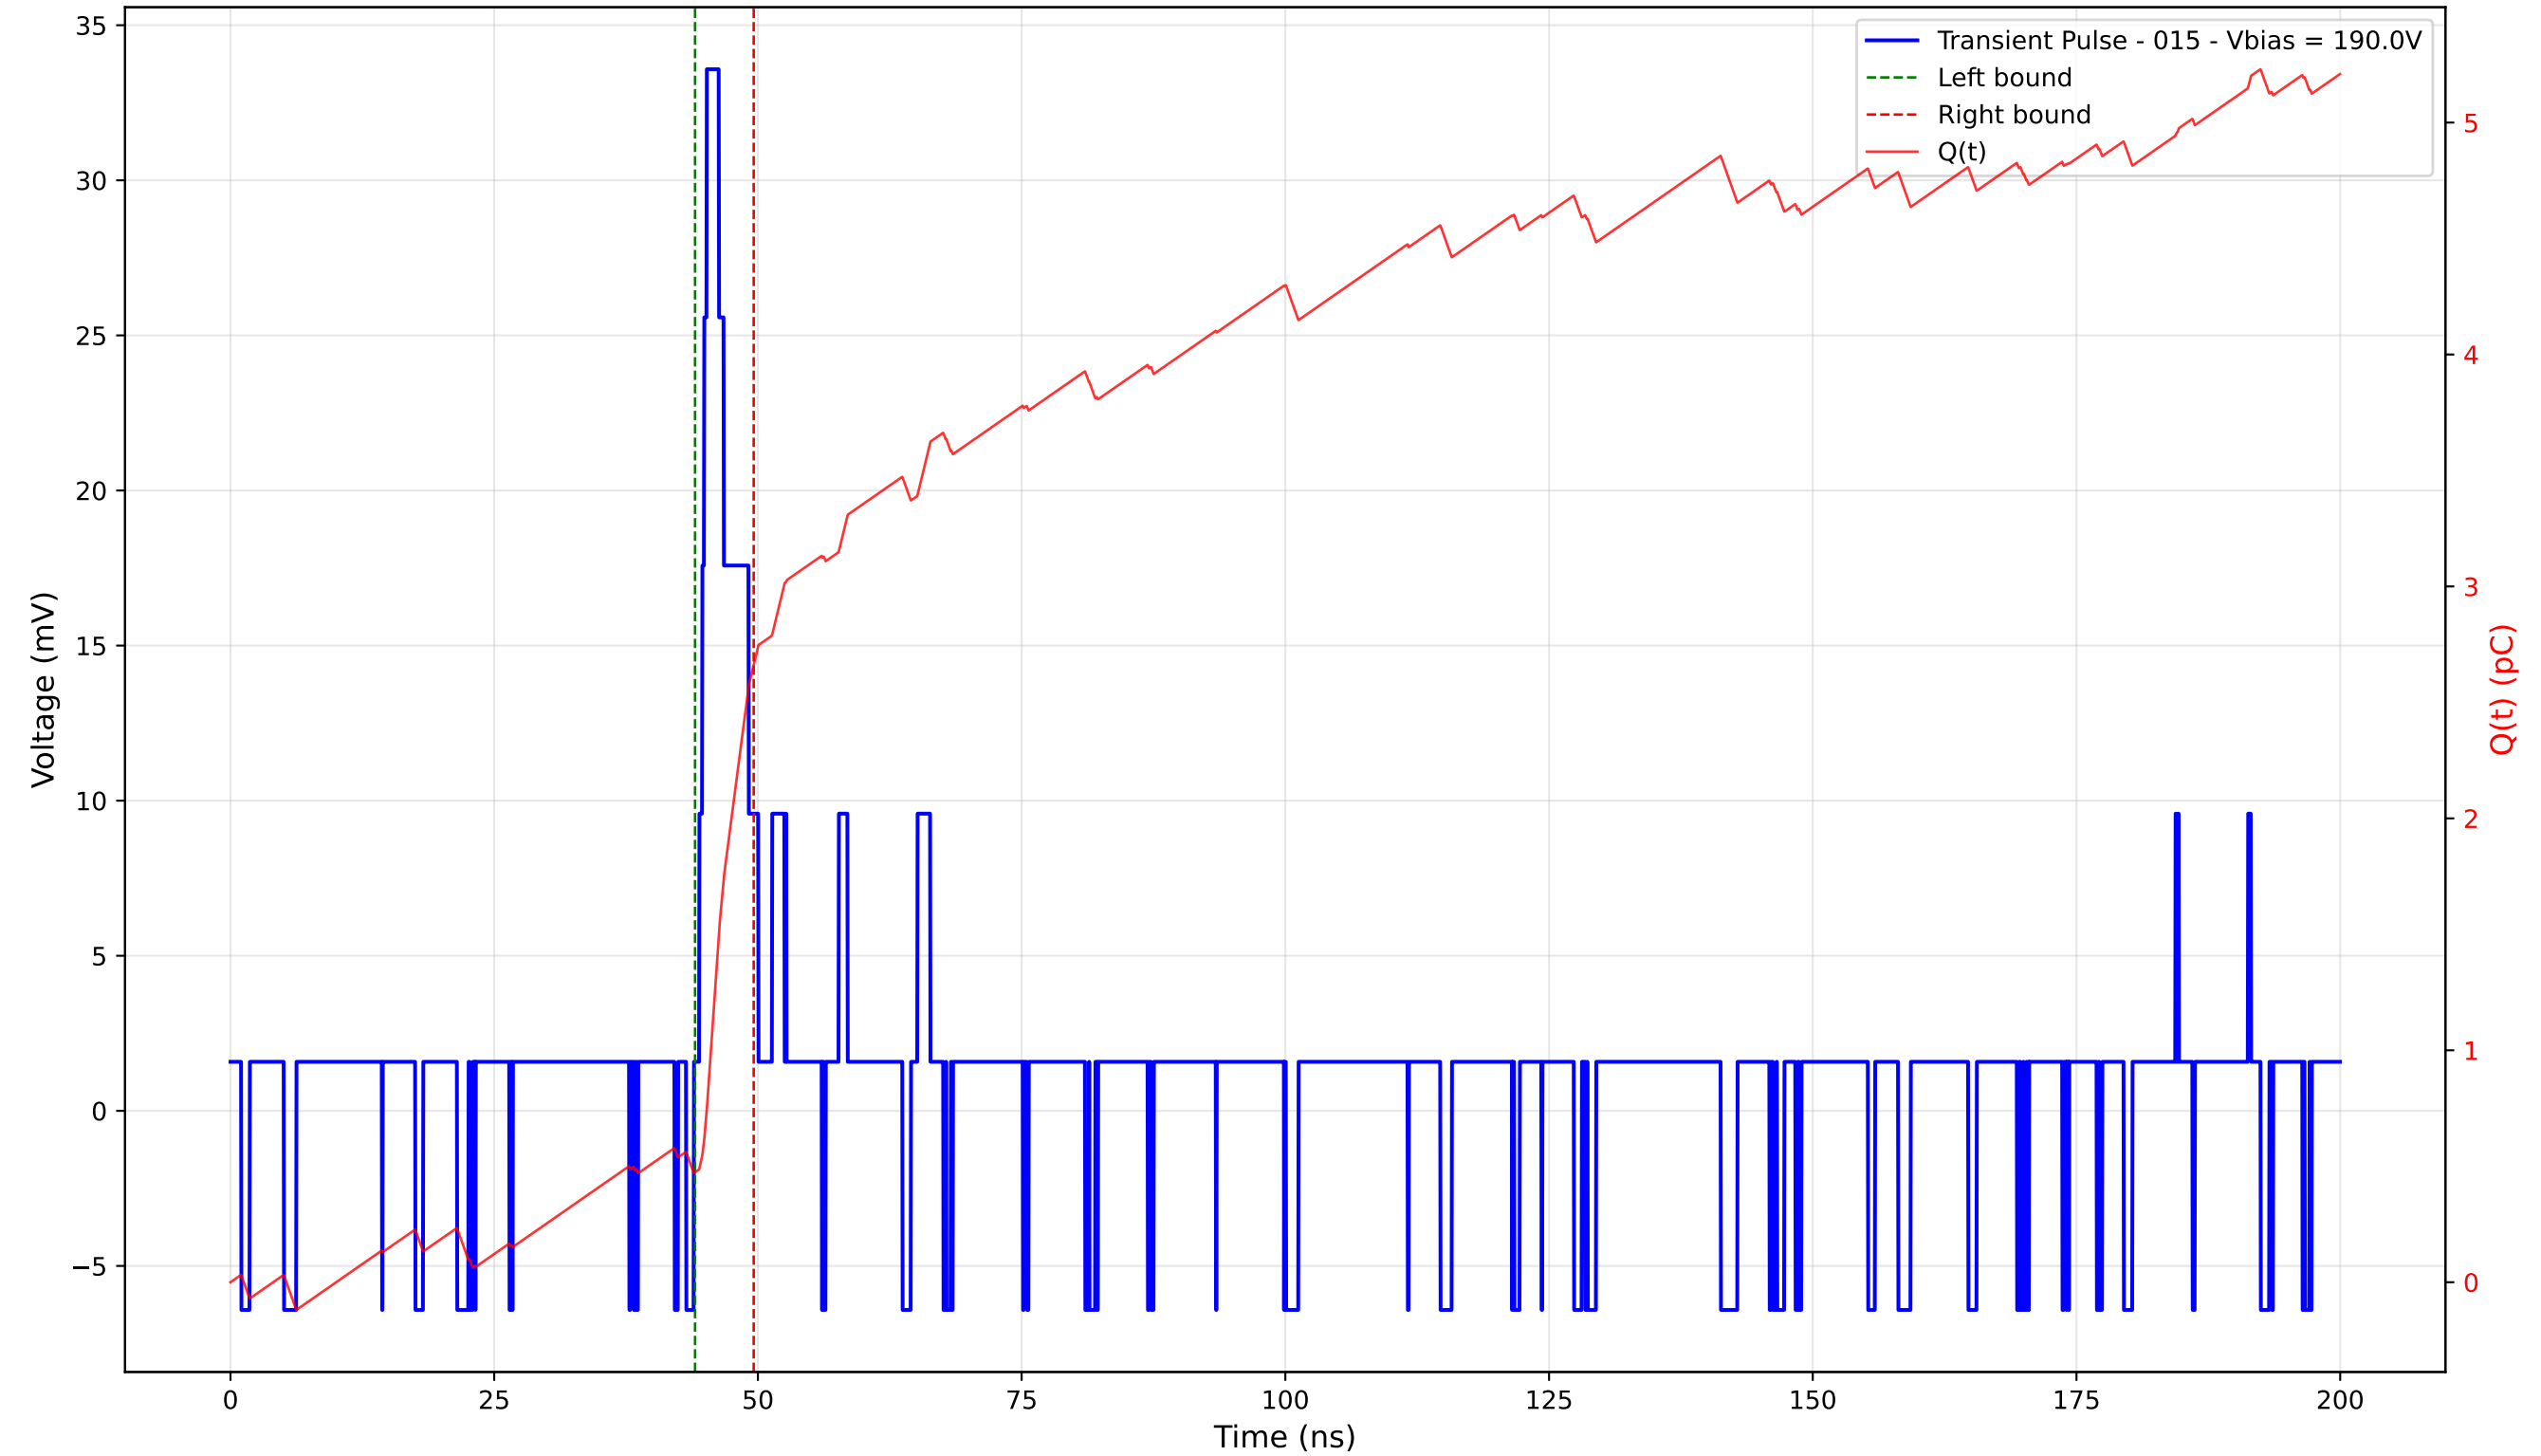

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.13 pC - Rise Time: 0.66 ns

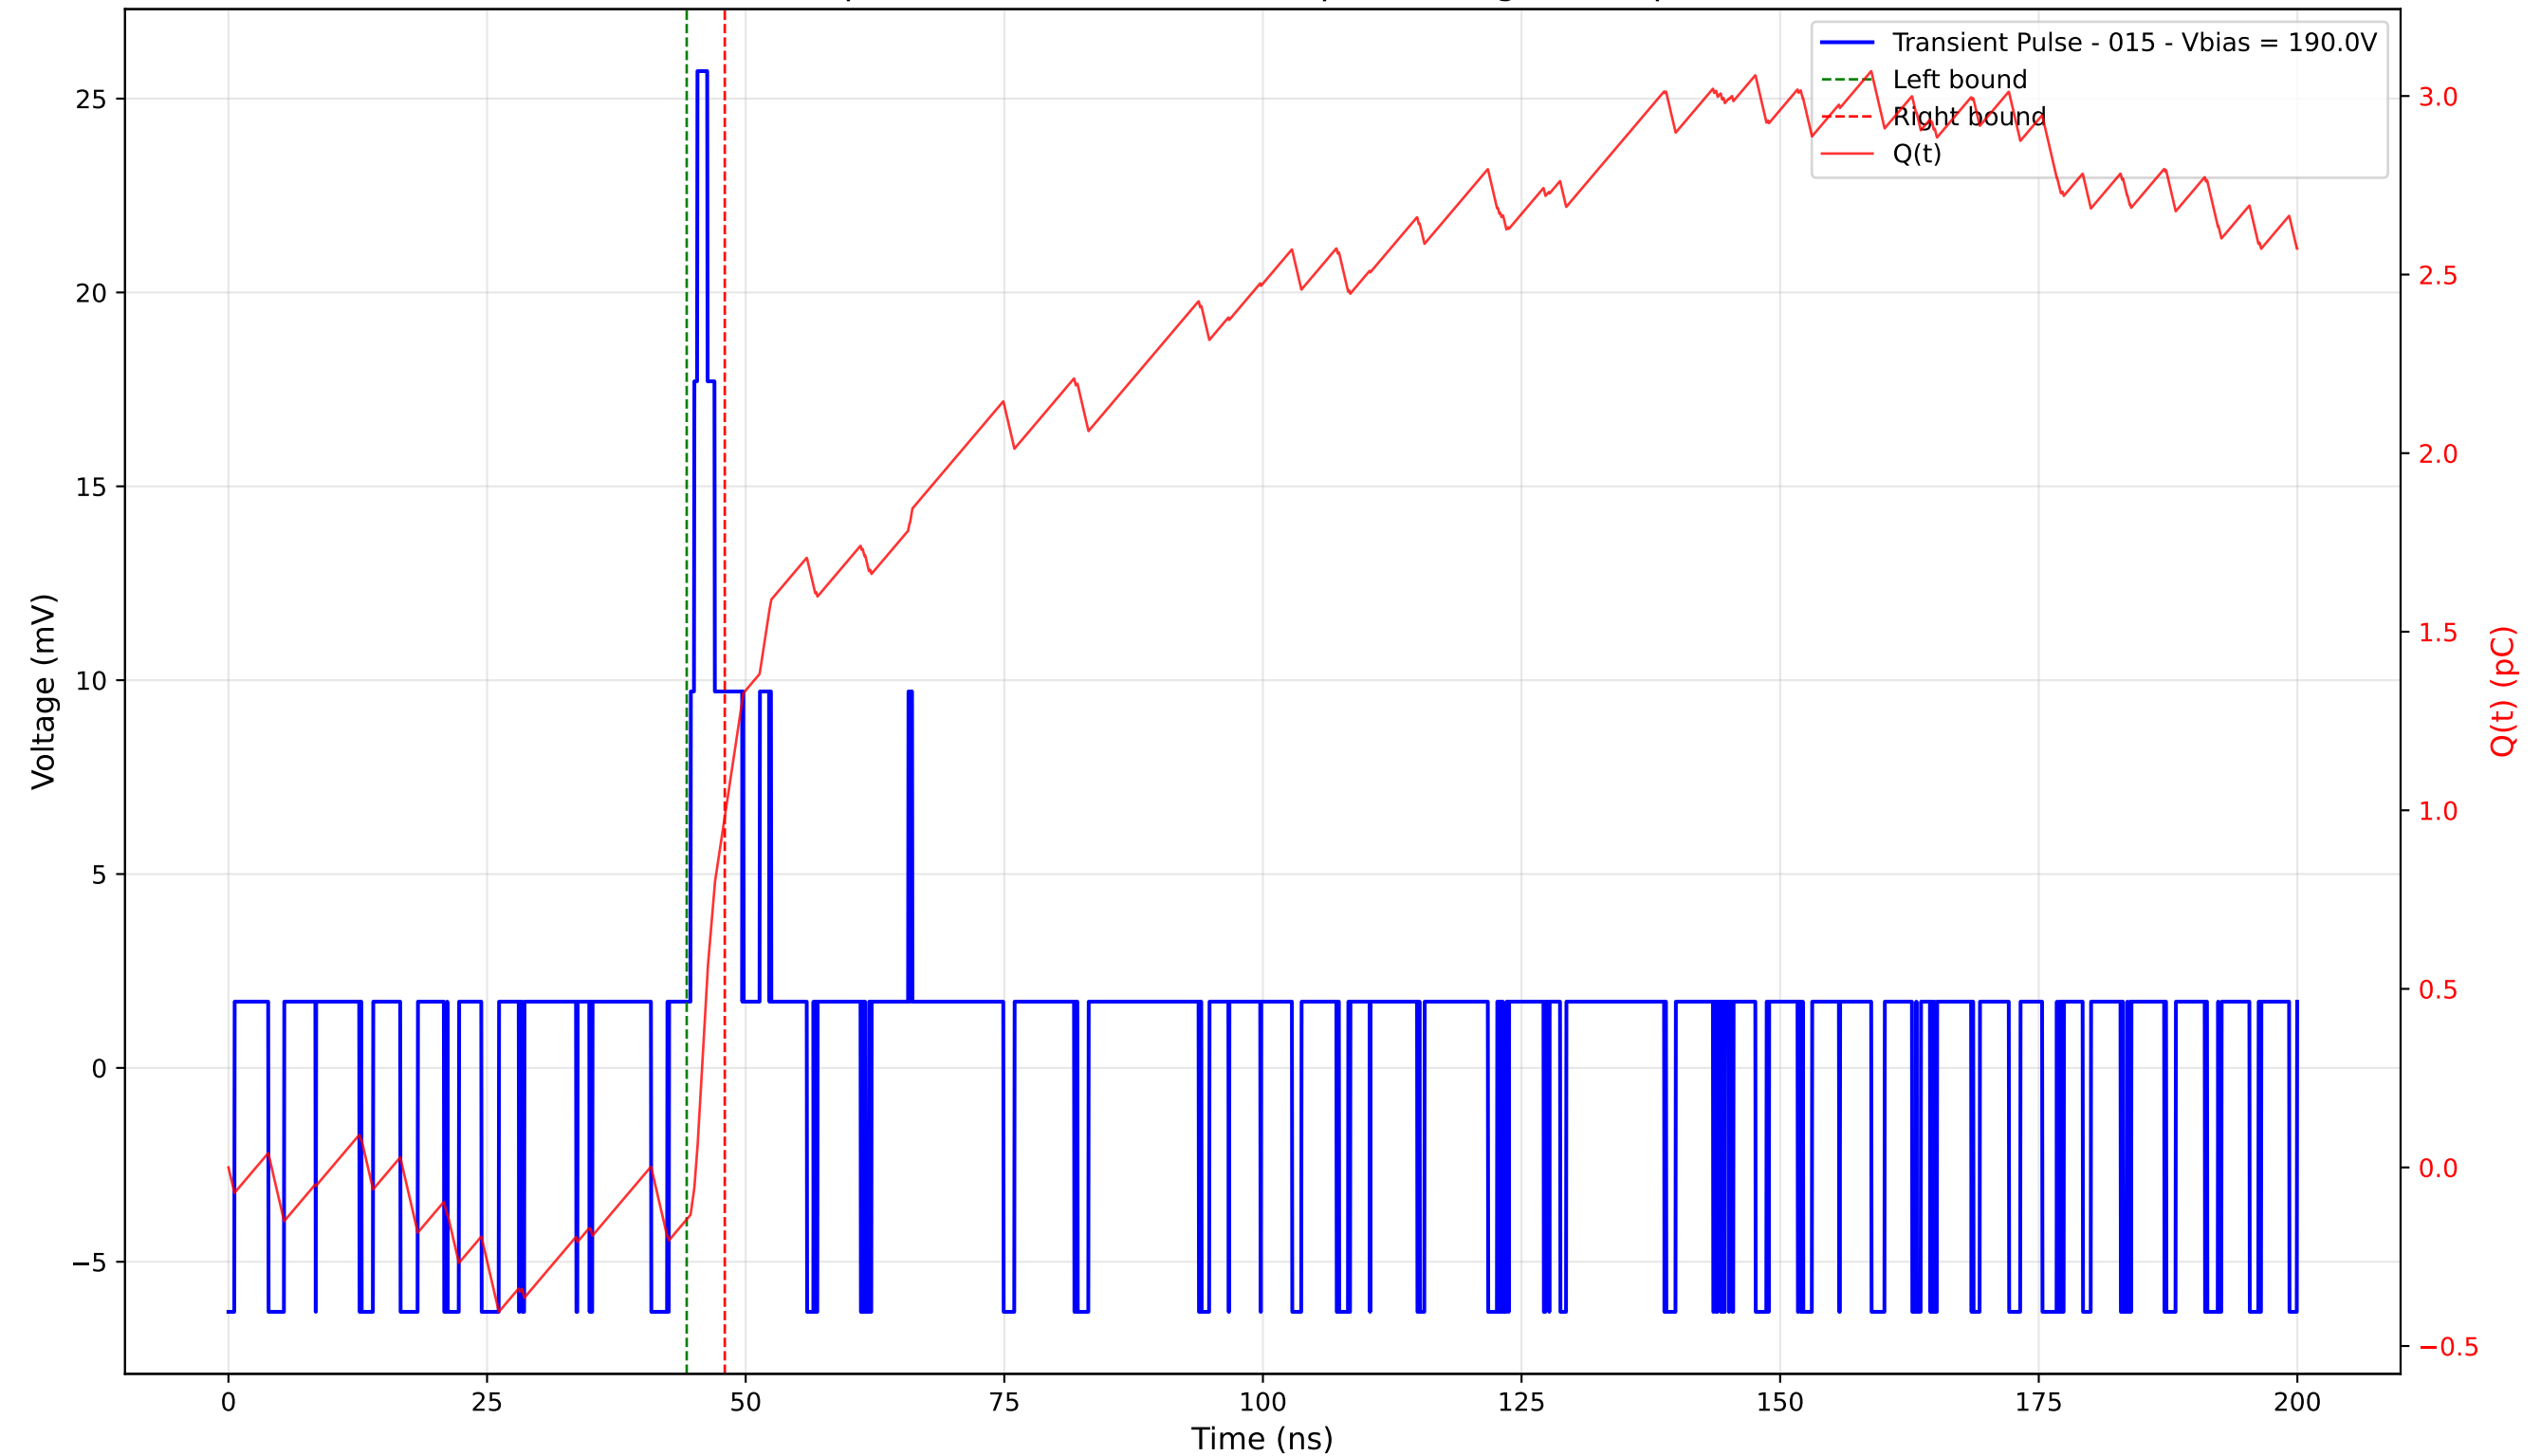

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 0.36 pC - Rise Time: 0.36 ns

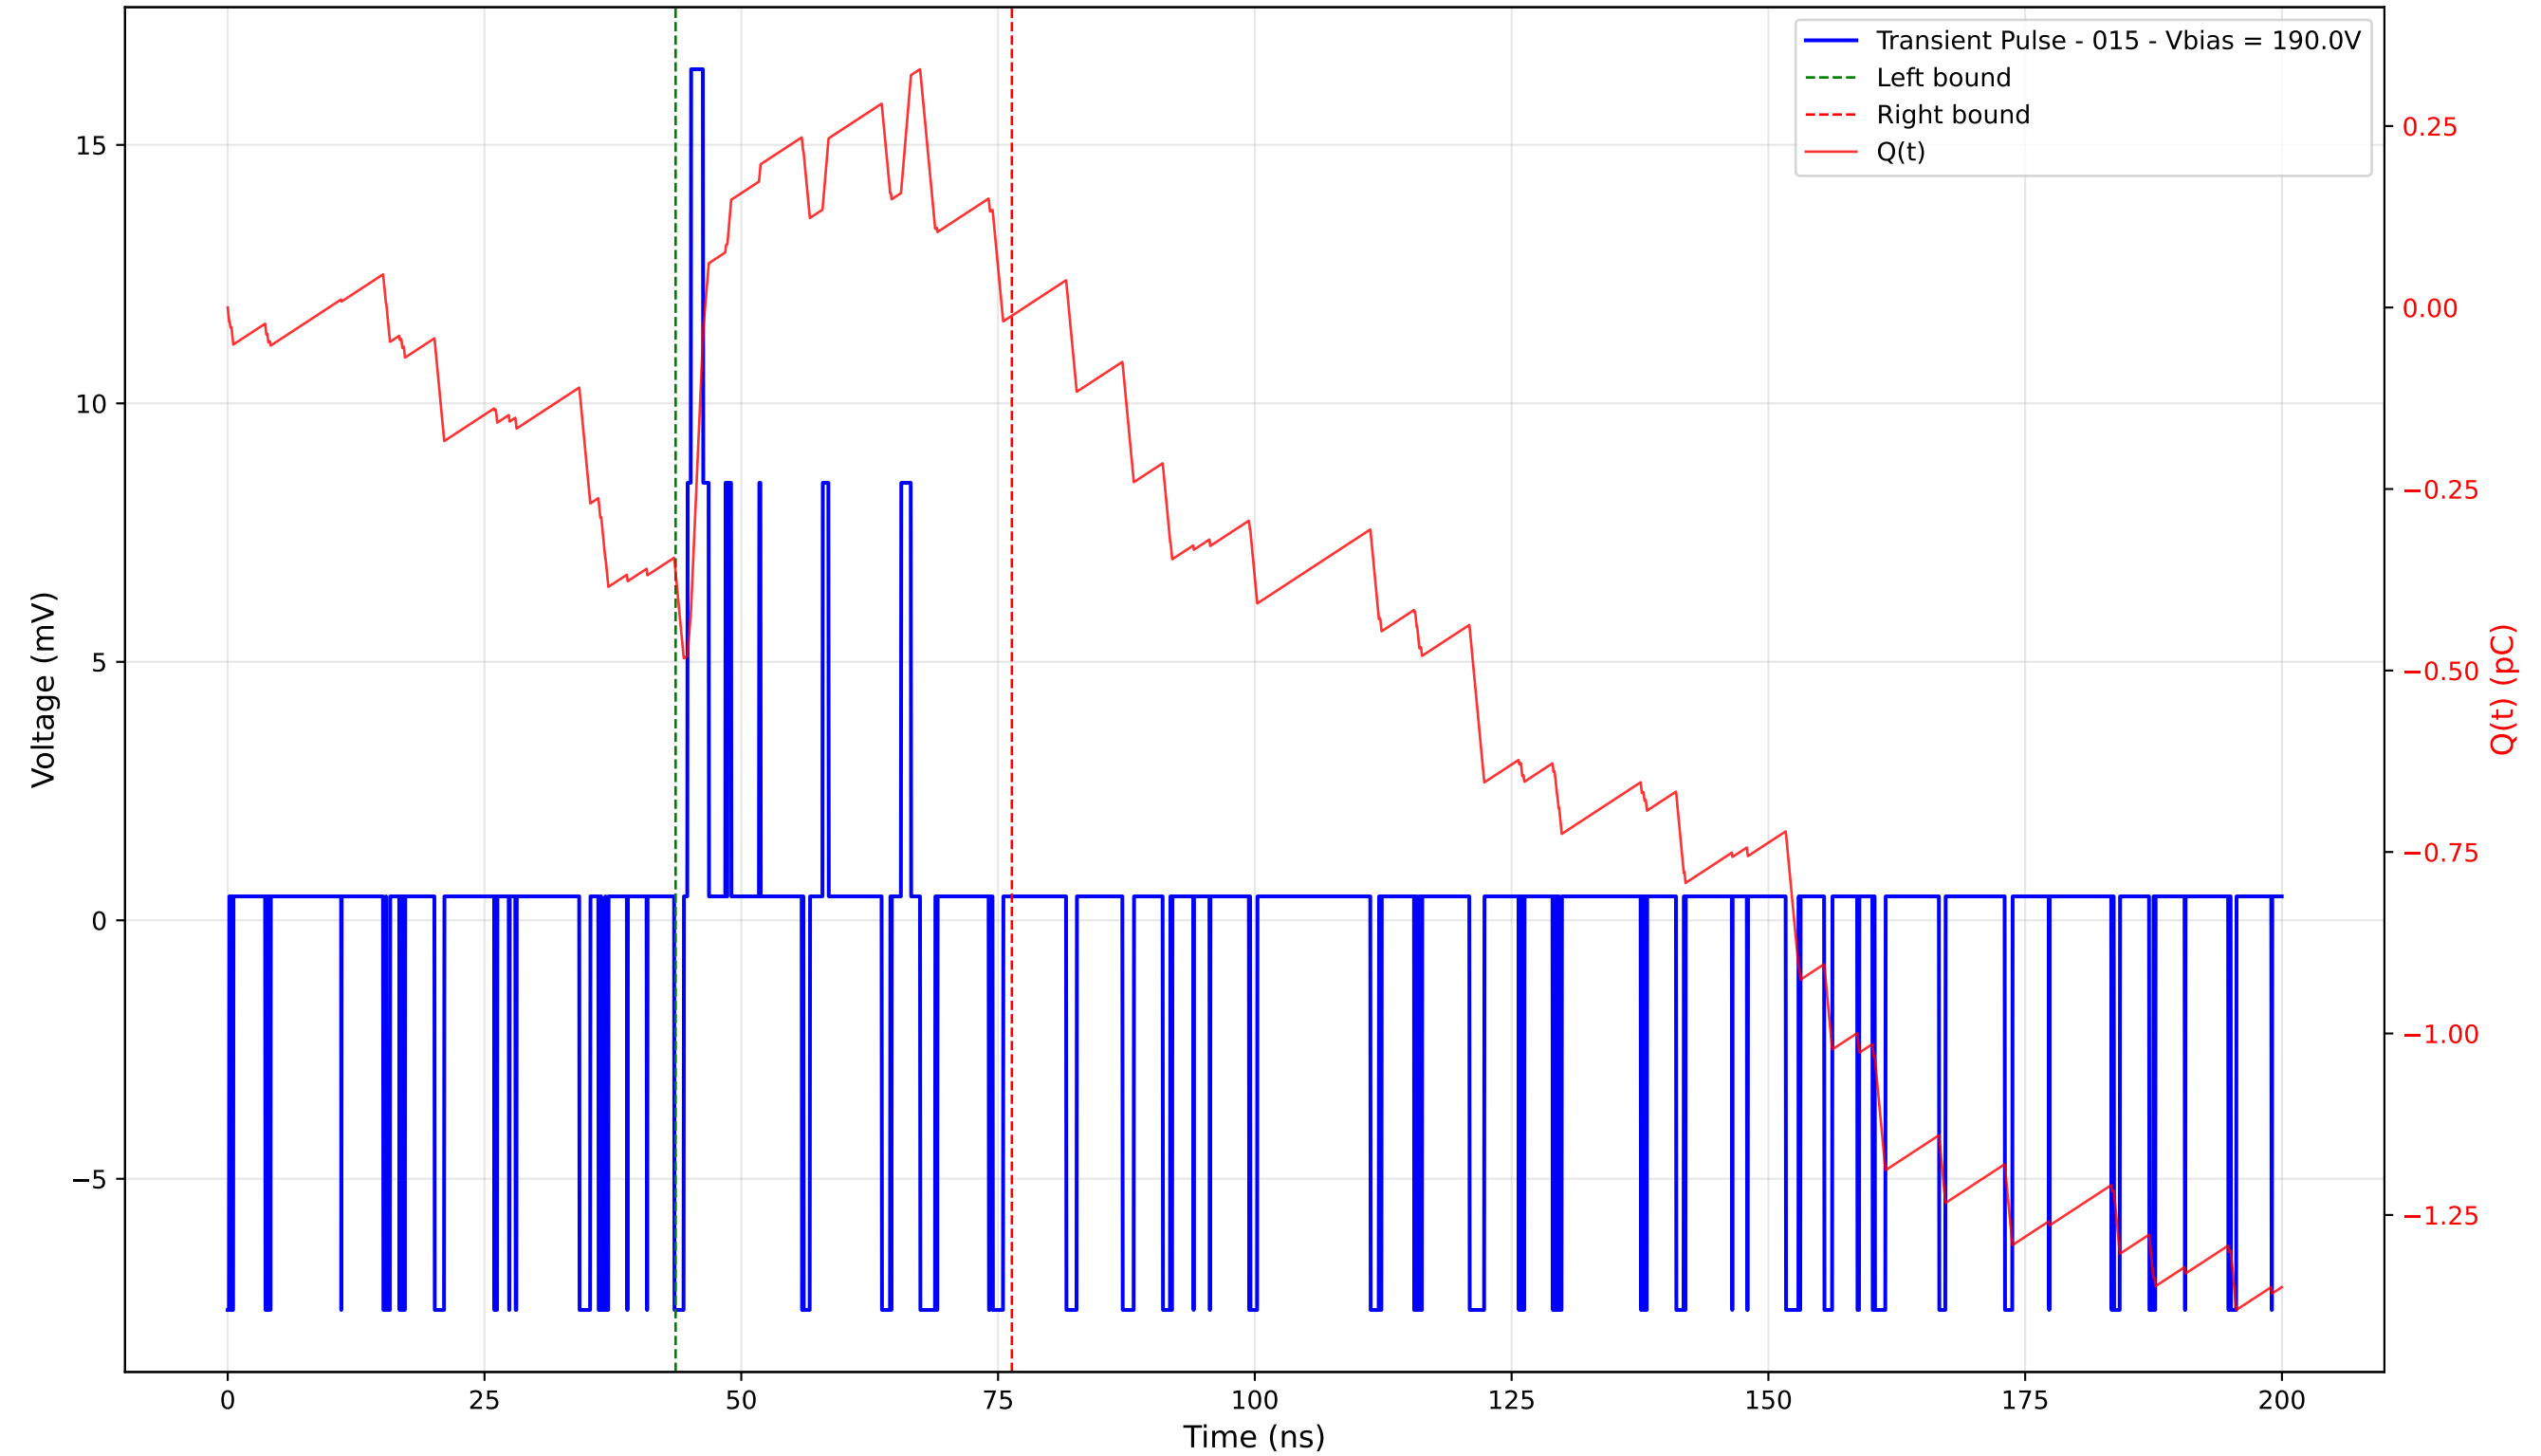

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.18 pC - Rise Time: 0.00 ns (N/A)

