


TCT Run 016 Summary

Parameter	Value
Run	Run016
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	170.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\170V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

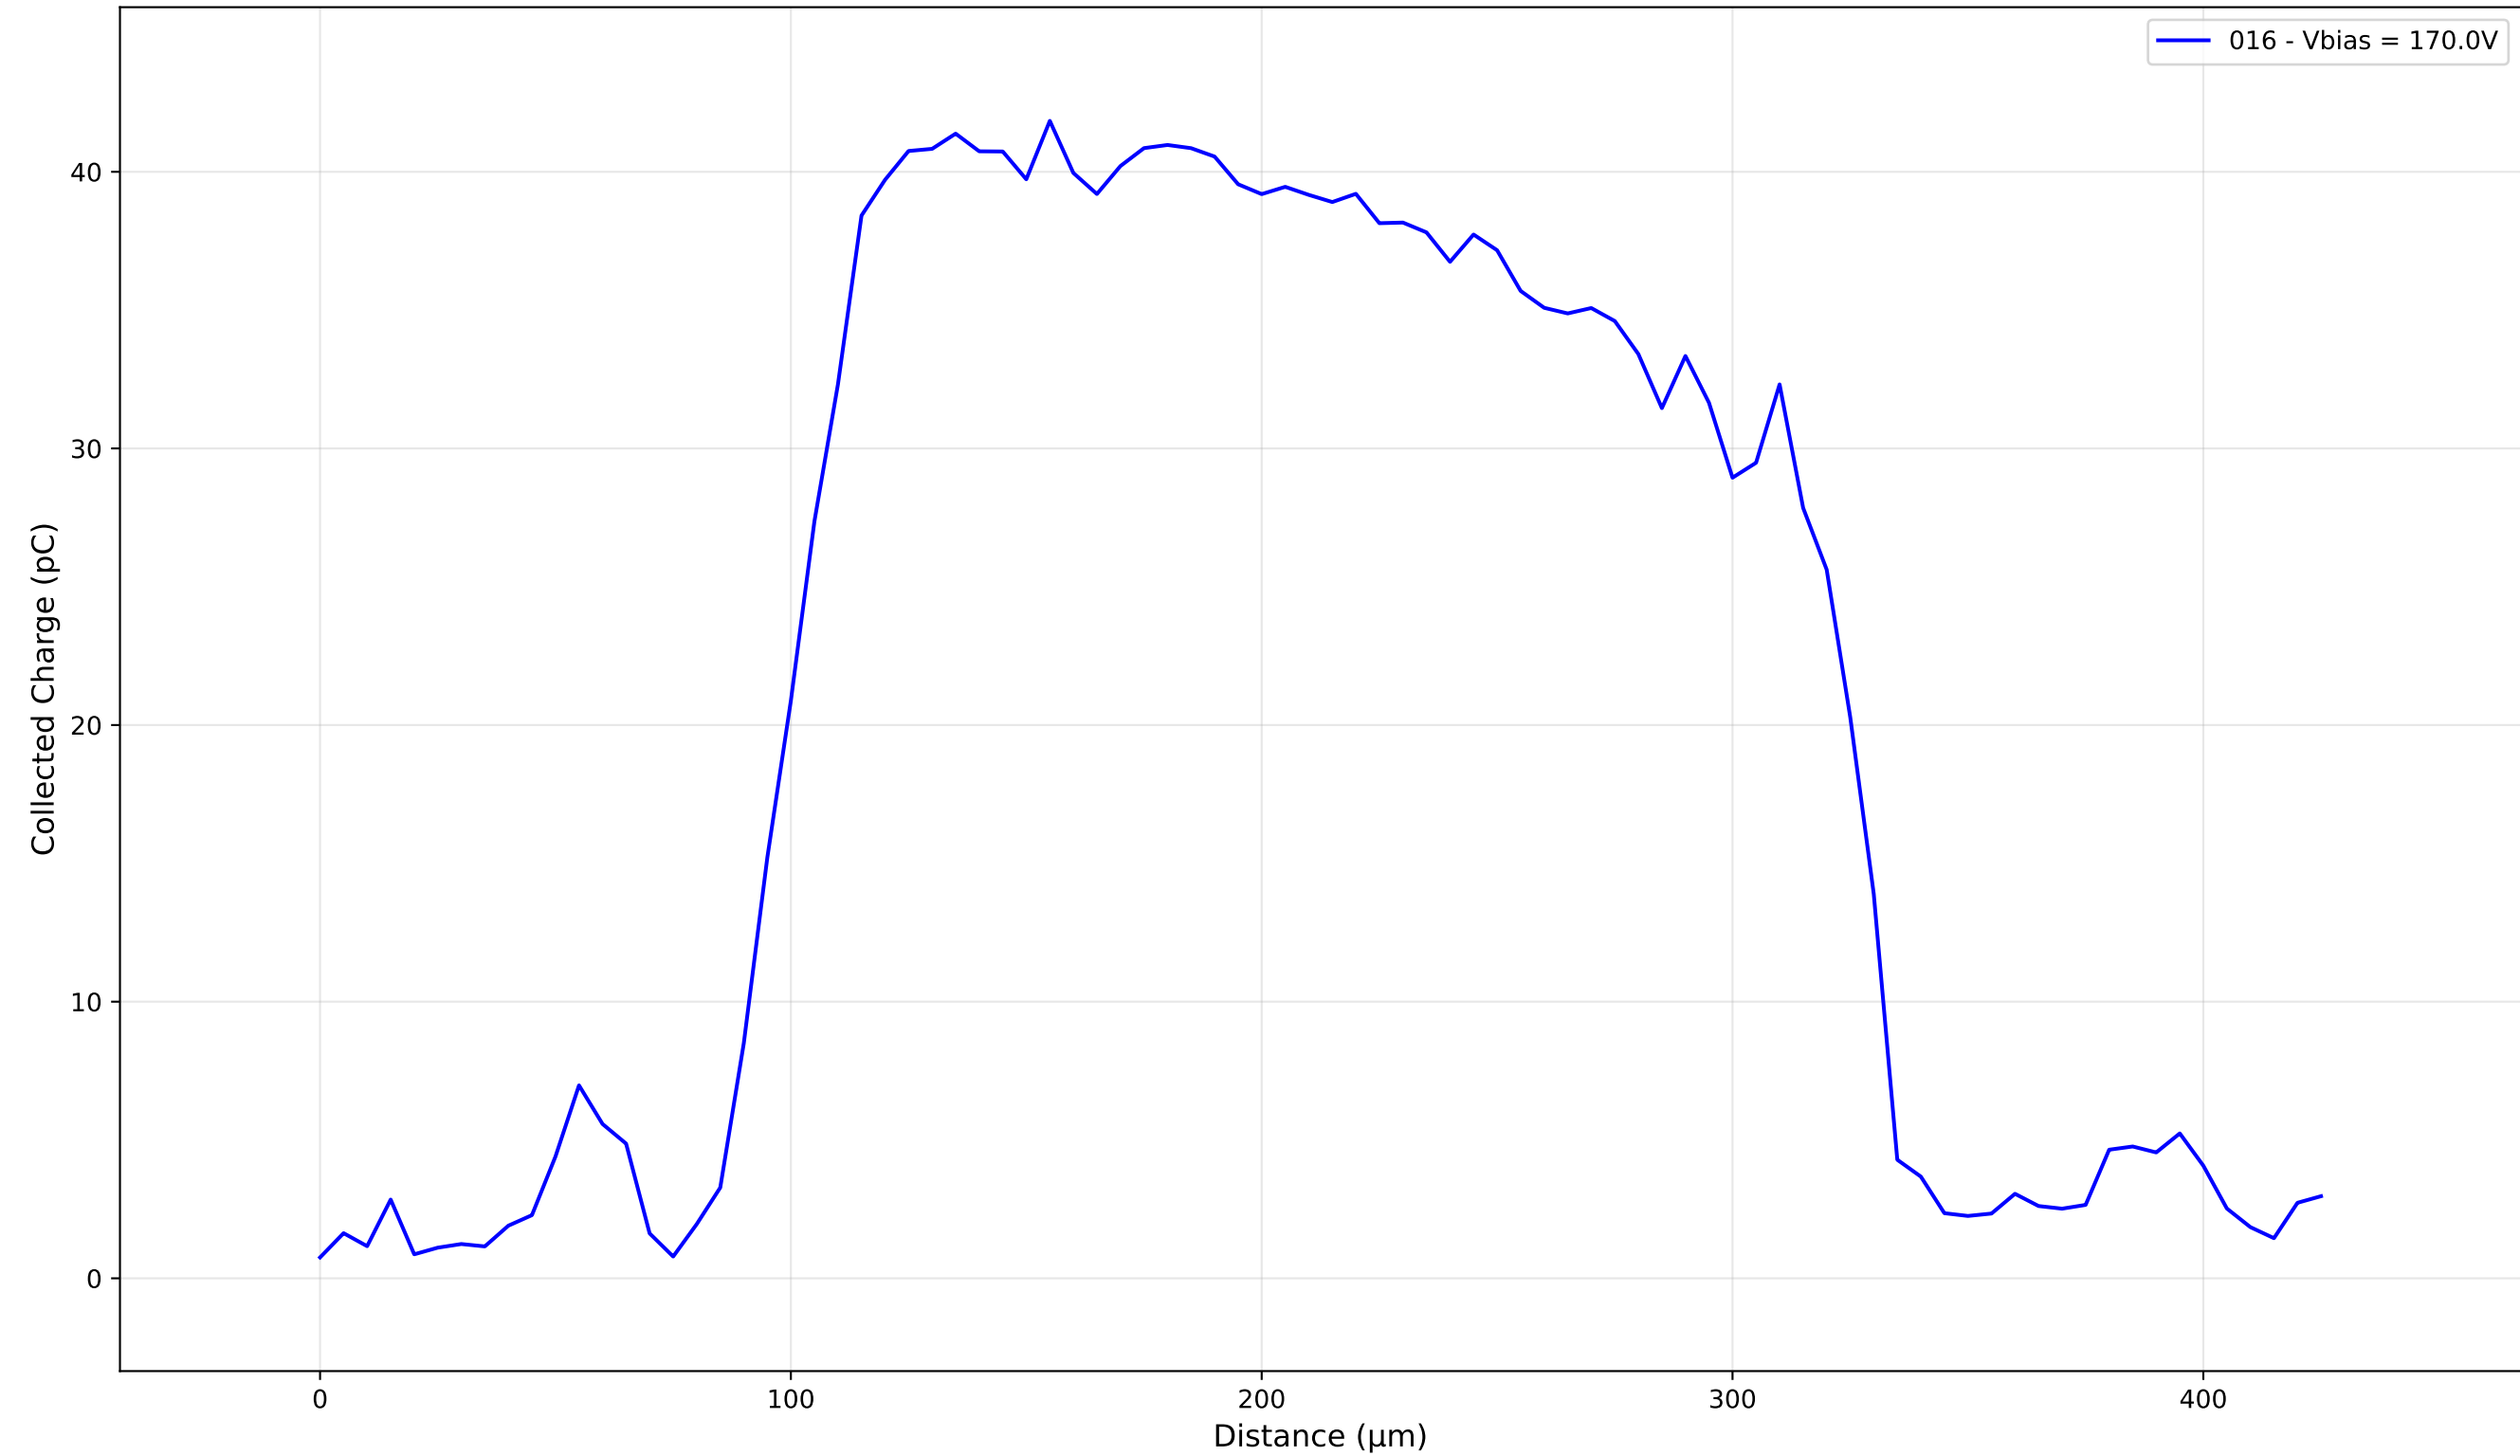

Collected Charge

016 - Vbias = 170.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

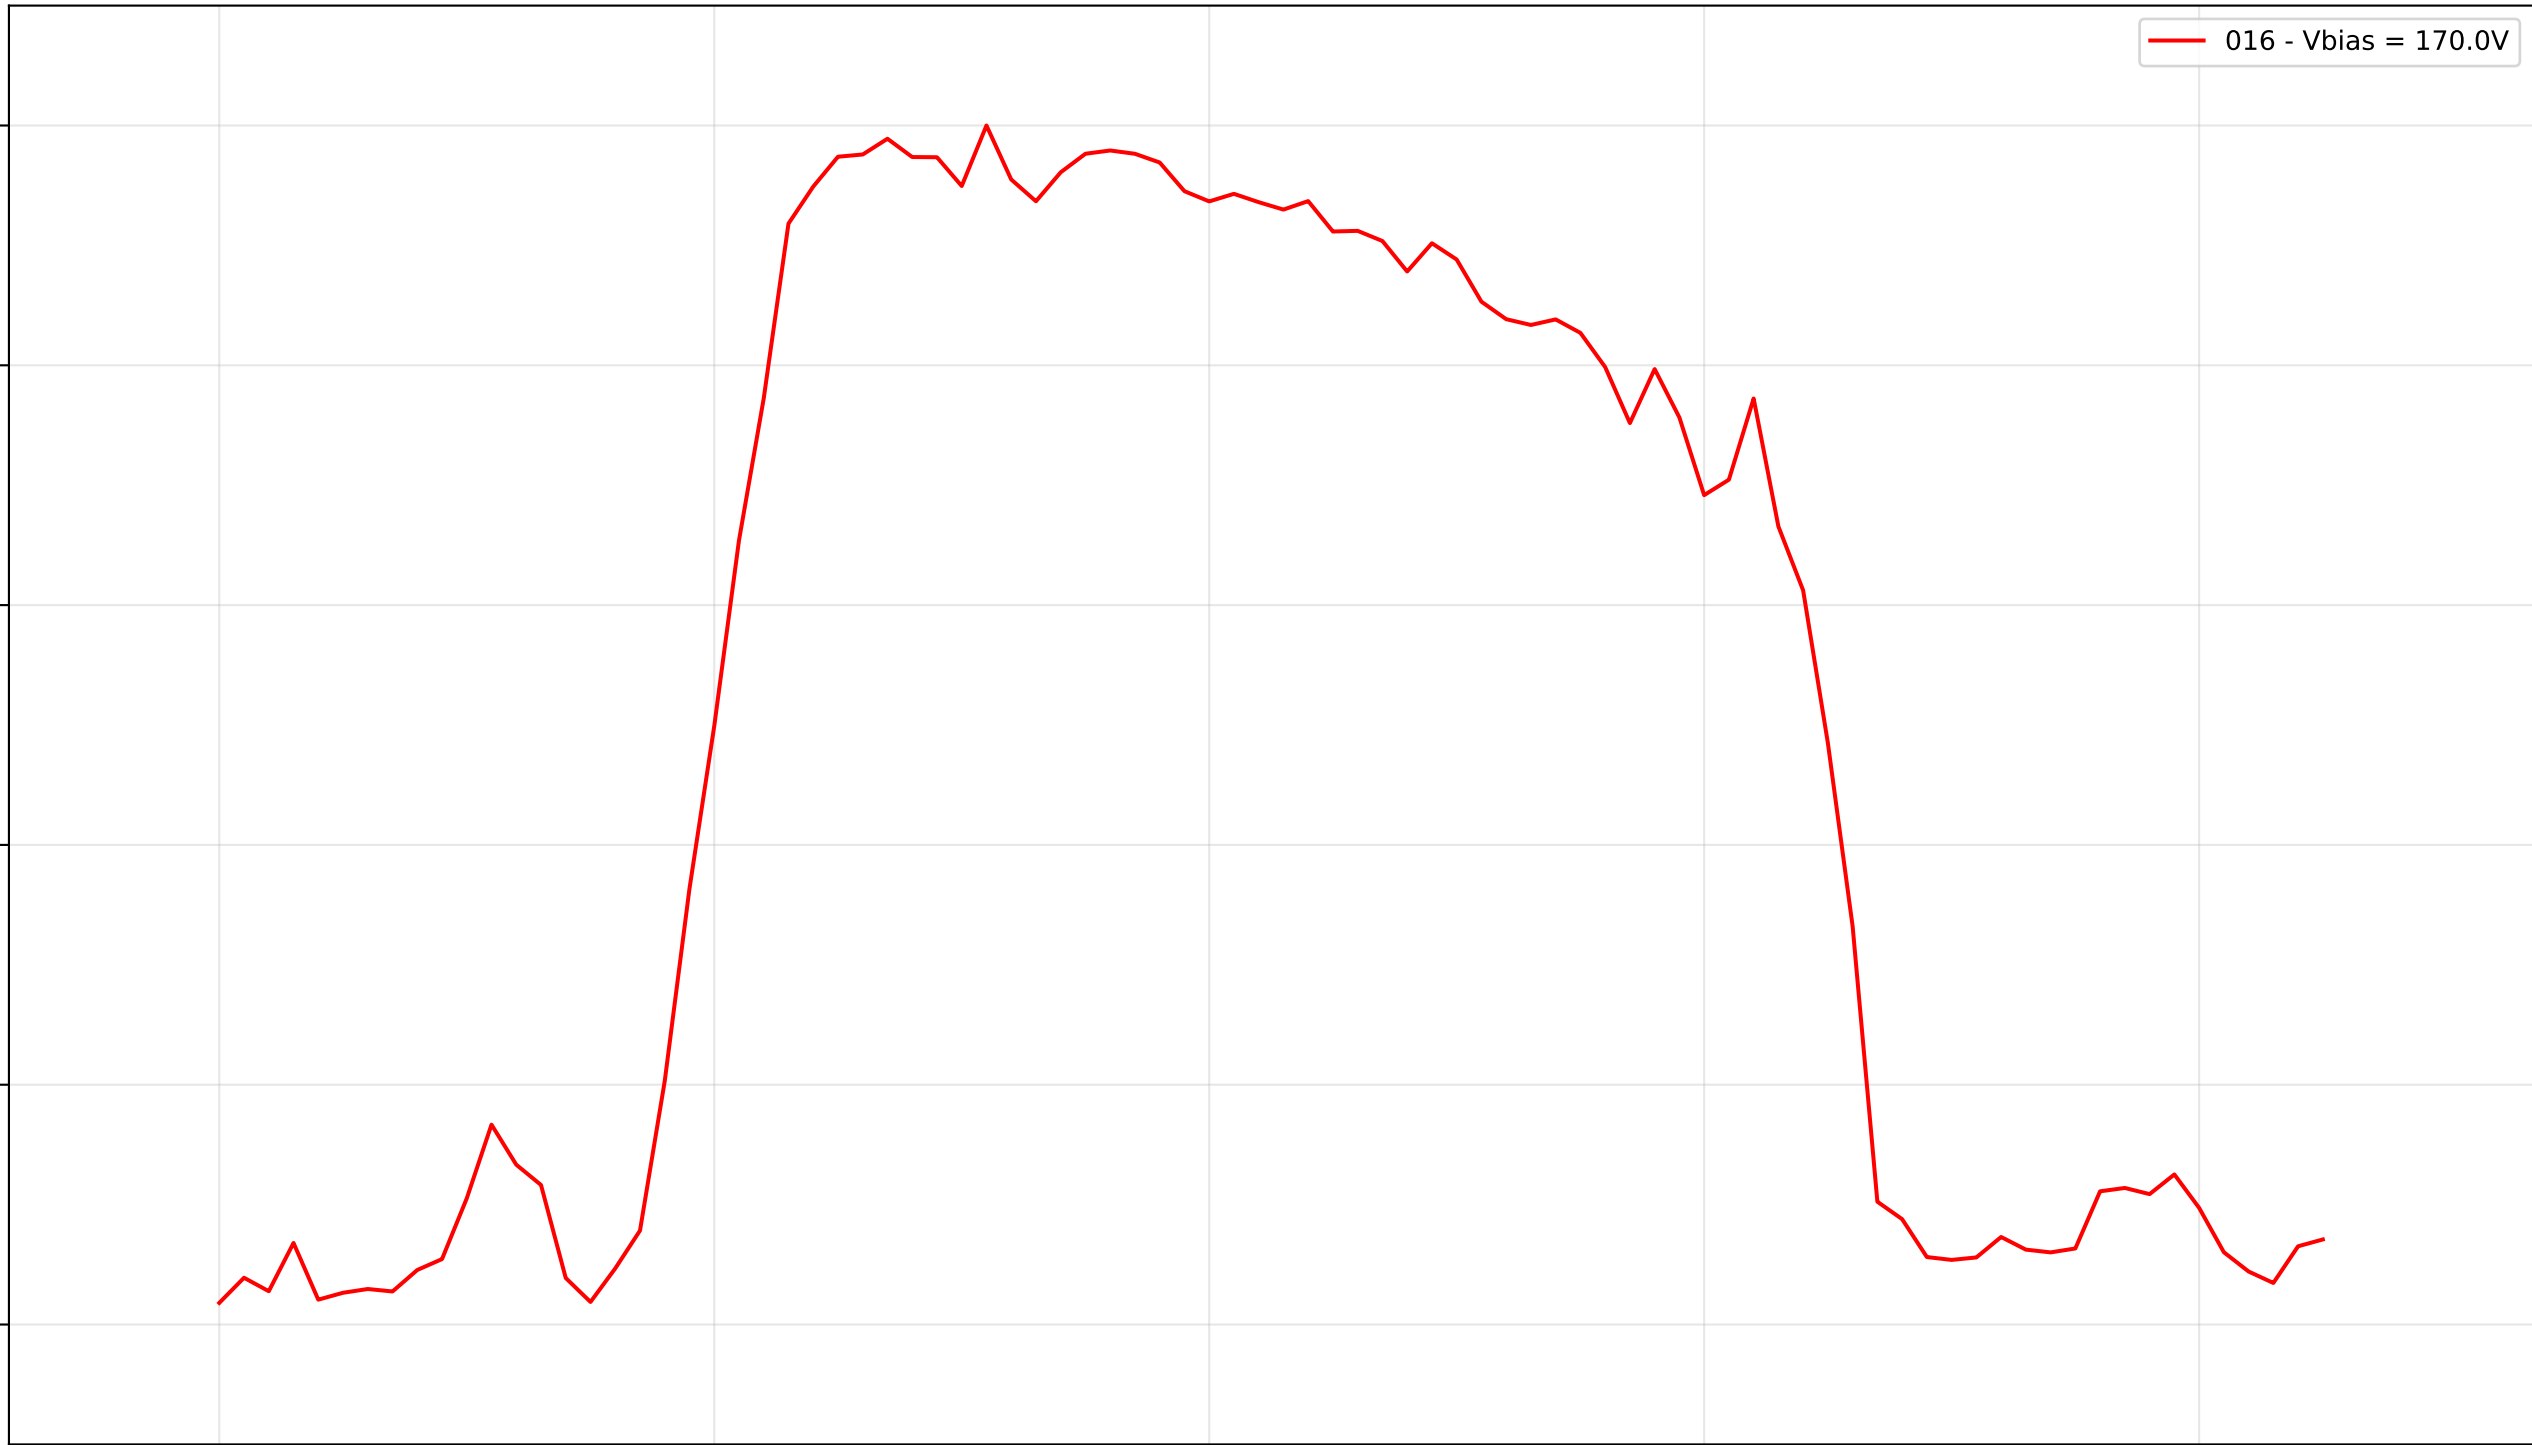


Rise Time

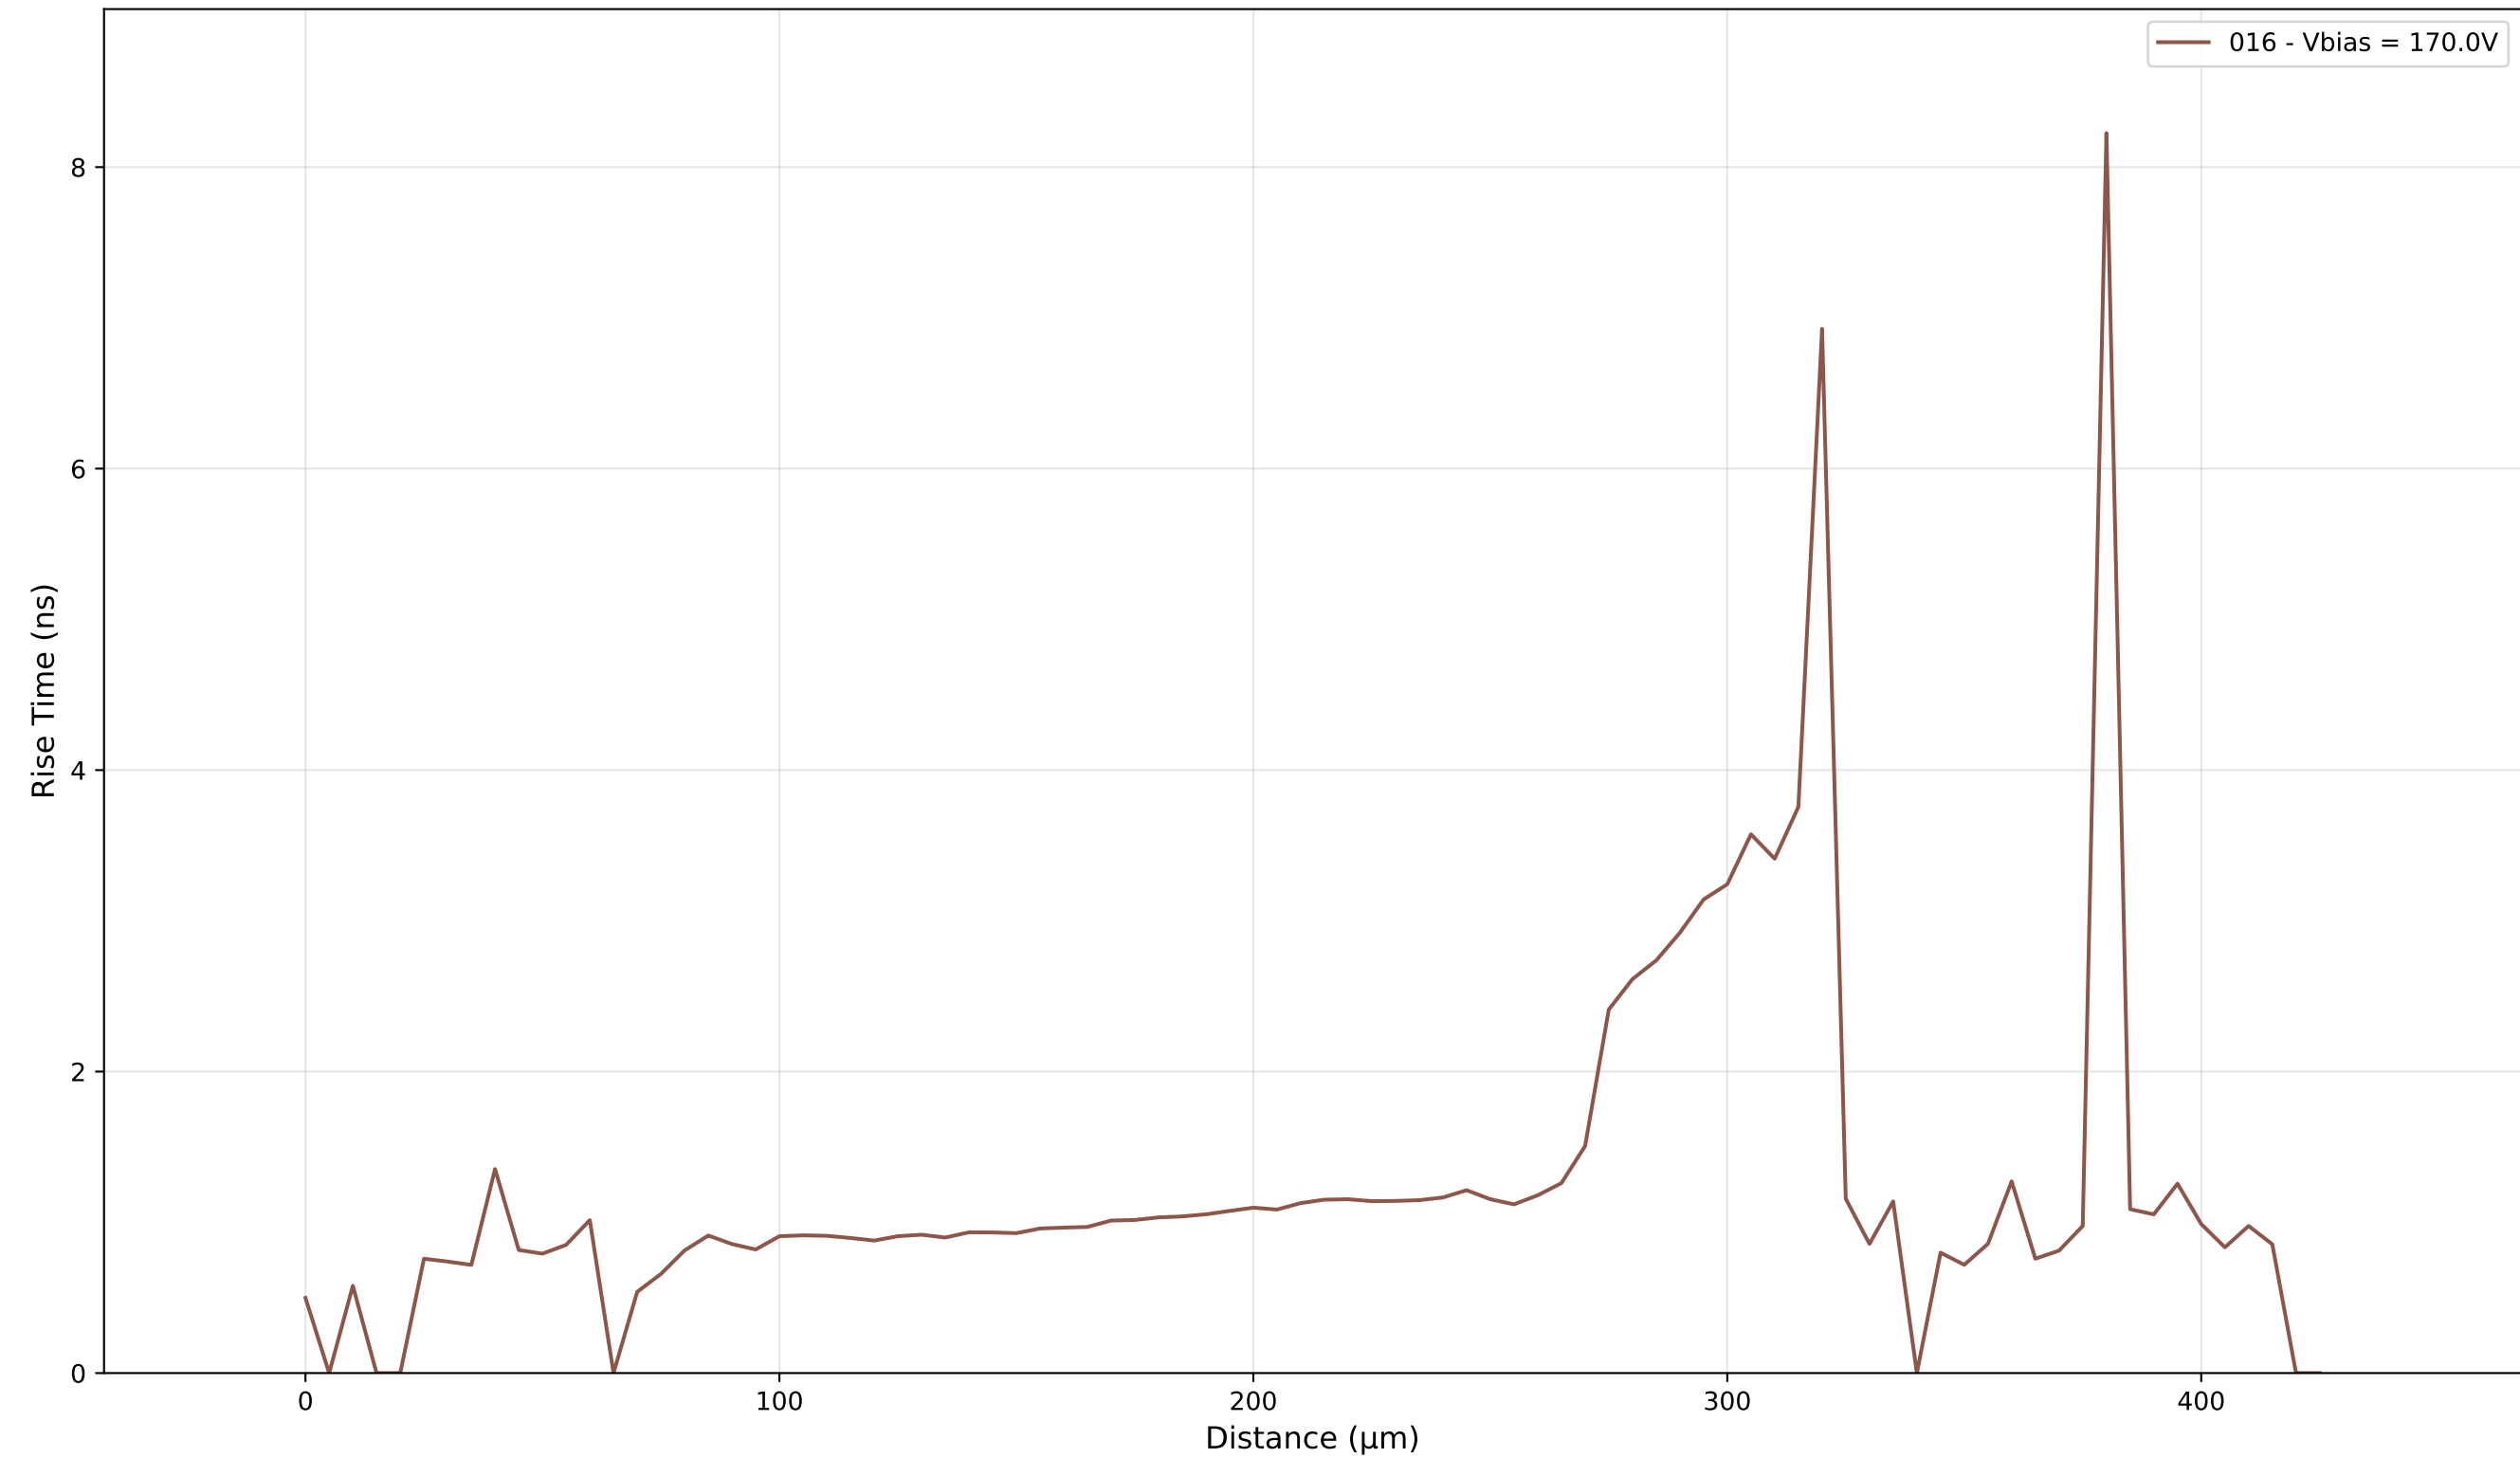


Amplitude

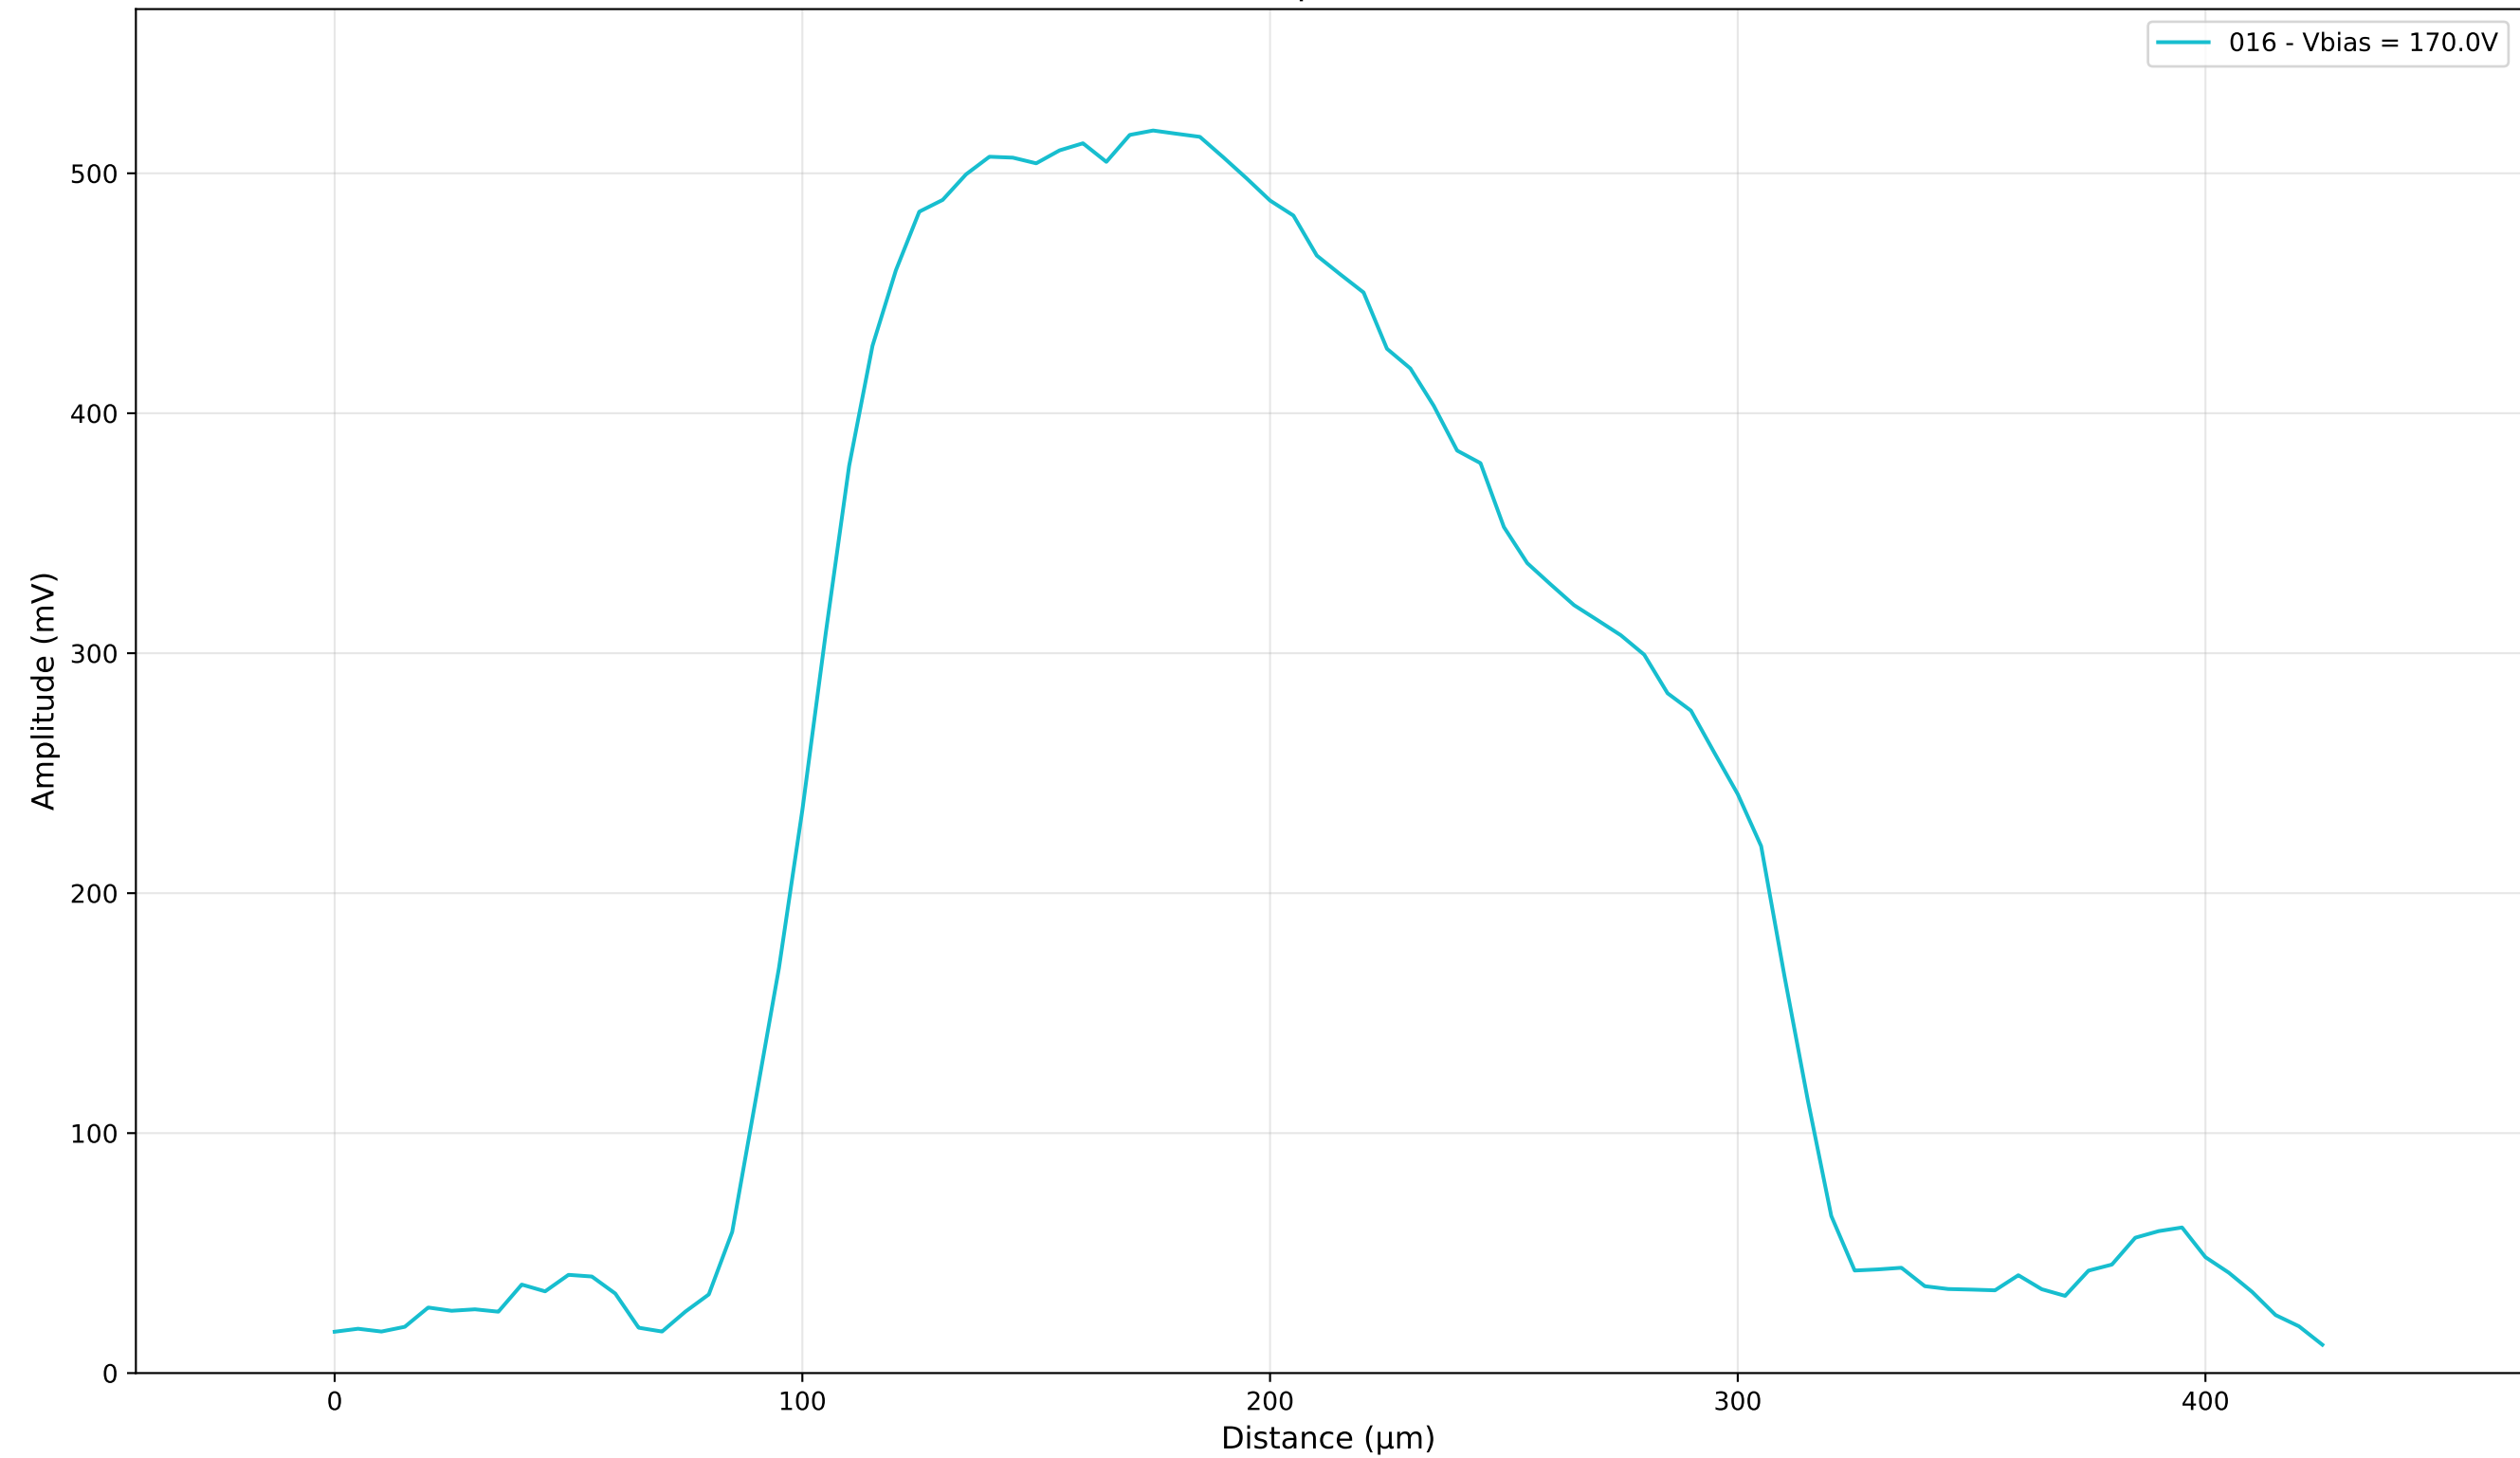


FWHM

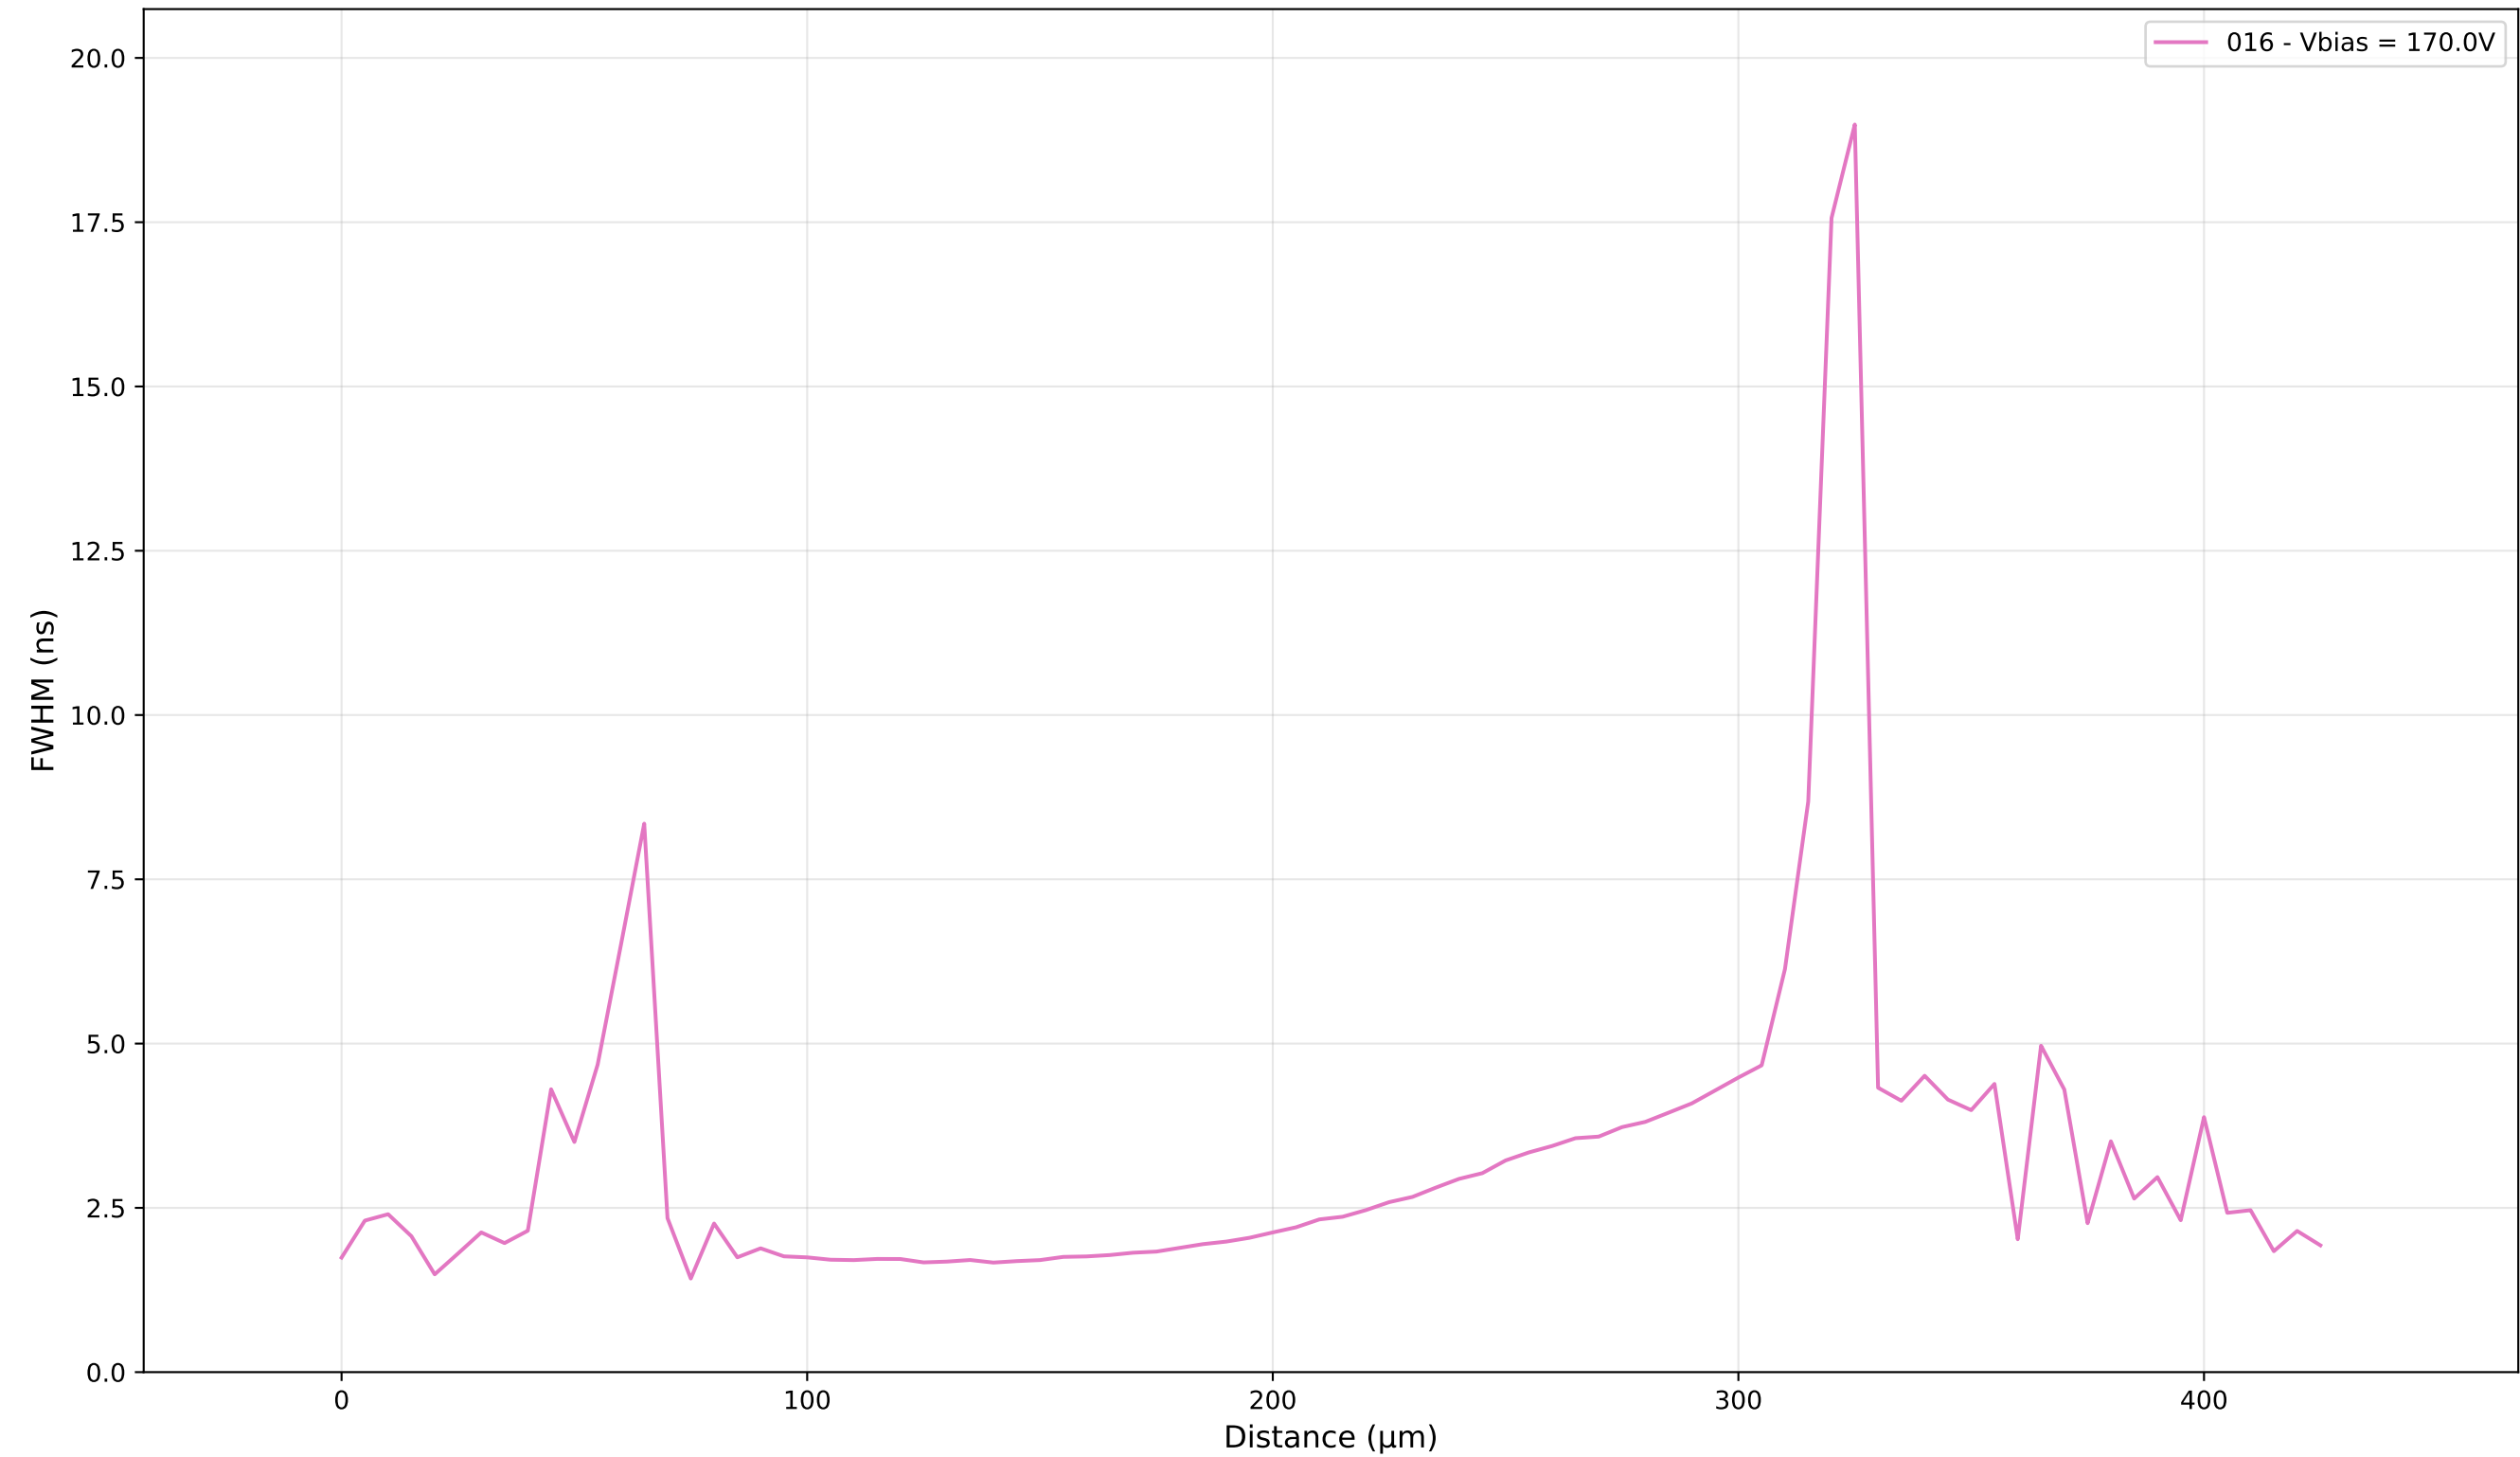


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.75 pC - Rise Time: 0.50 ns

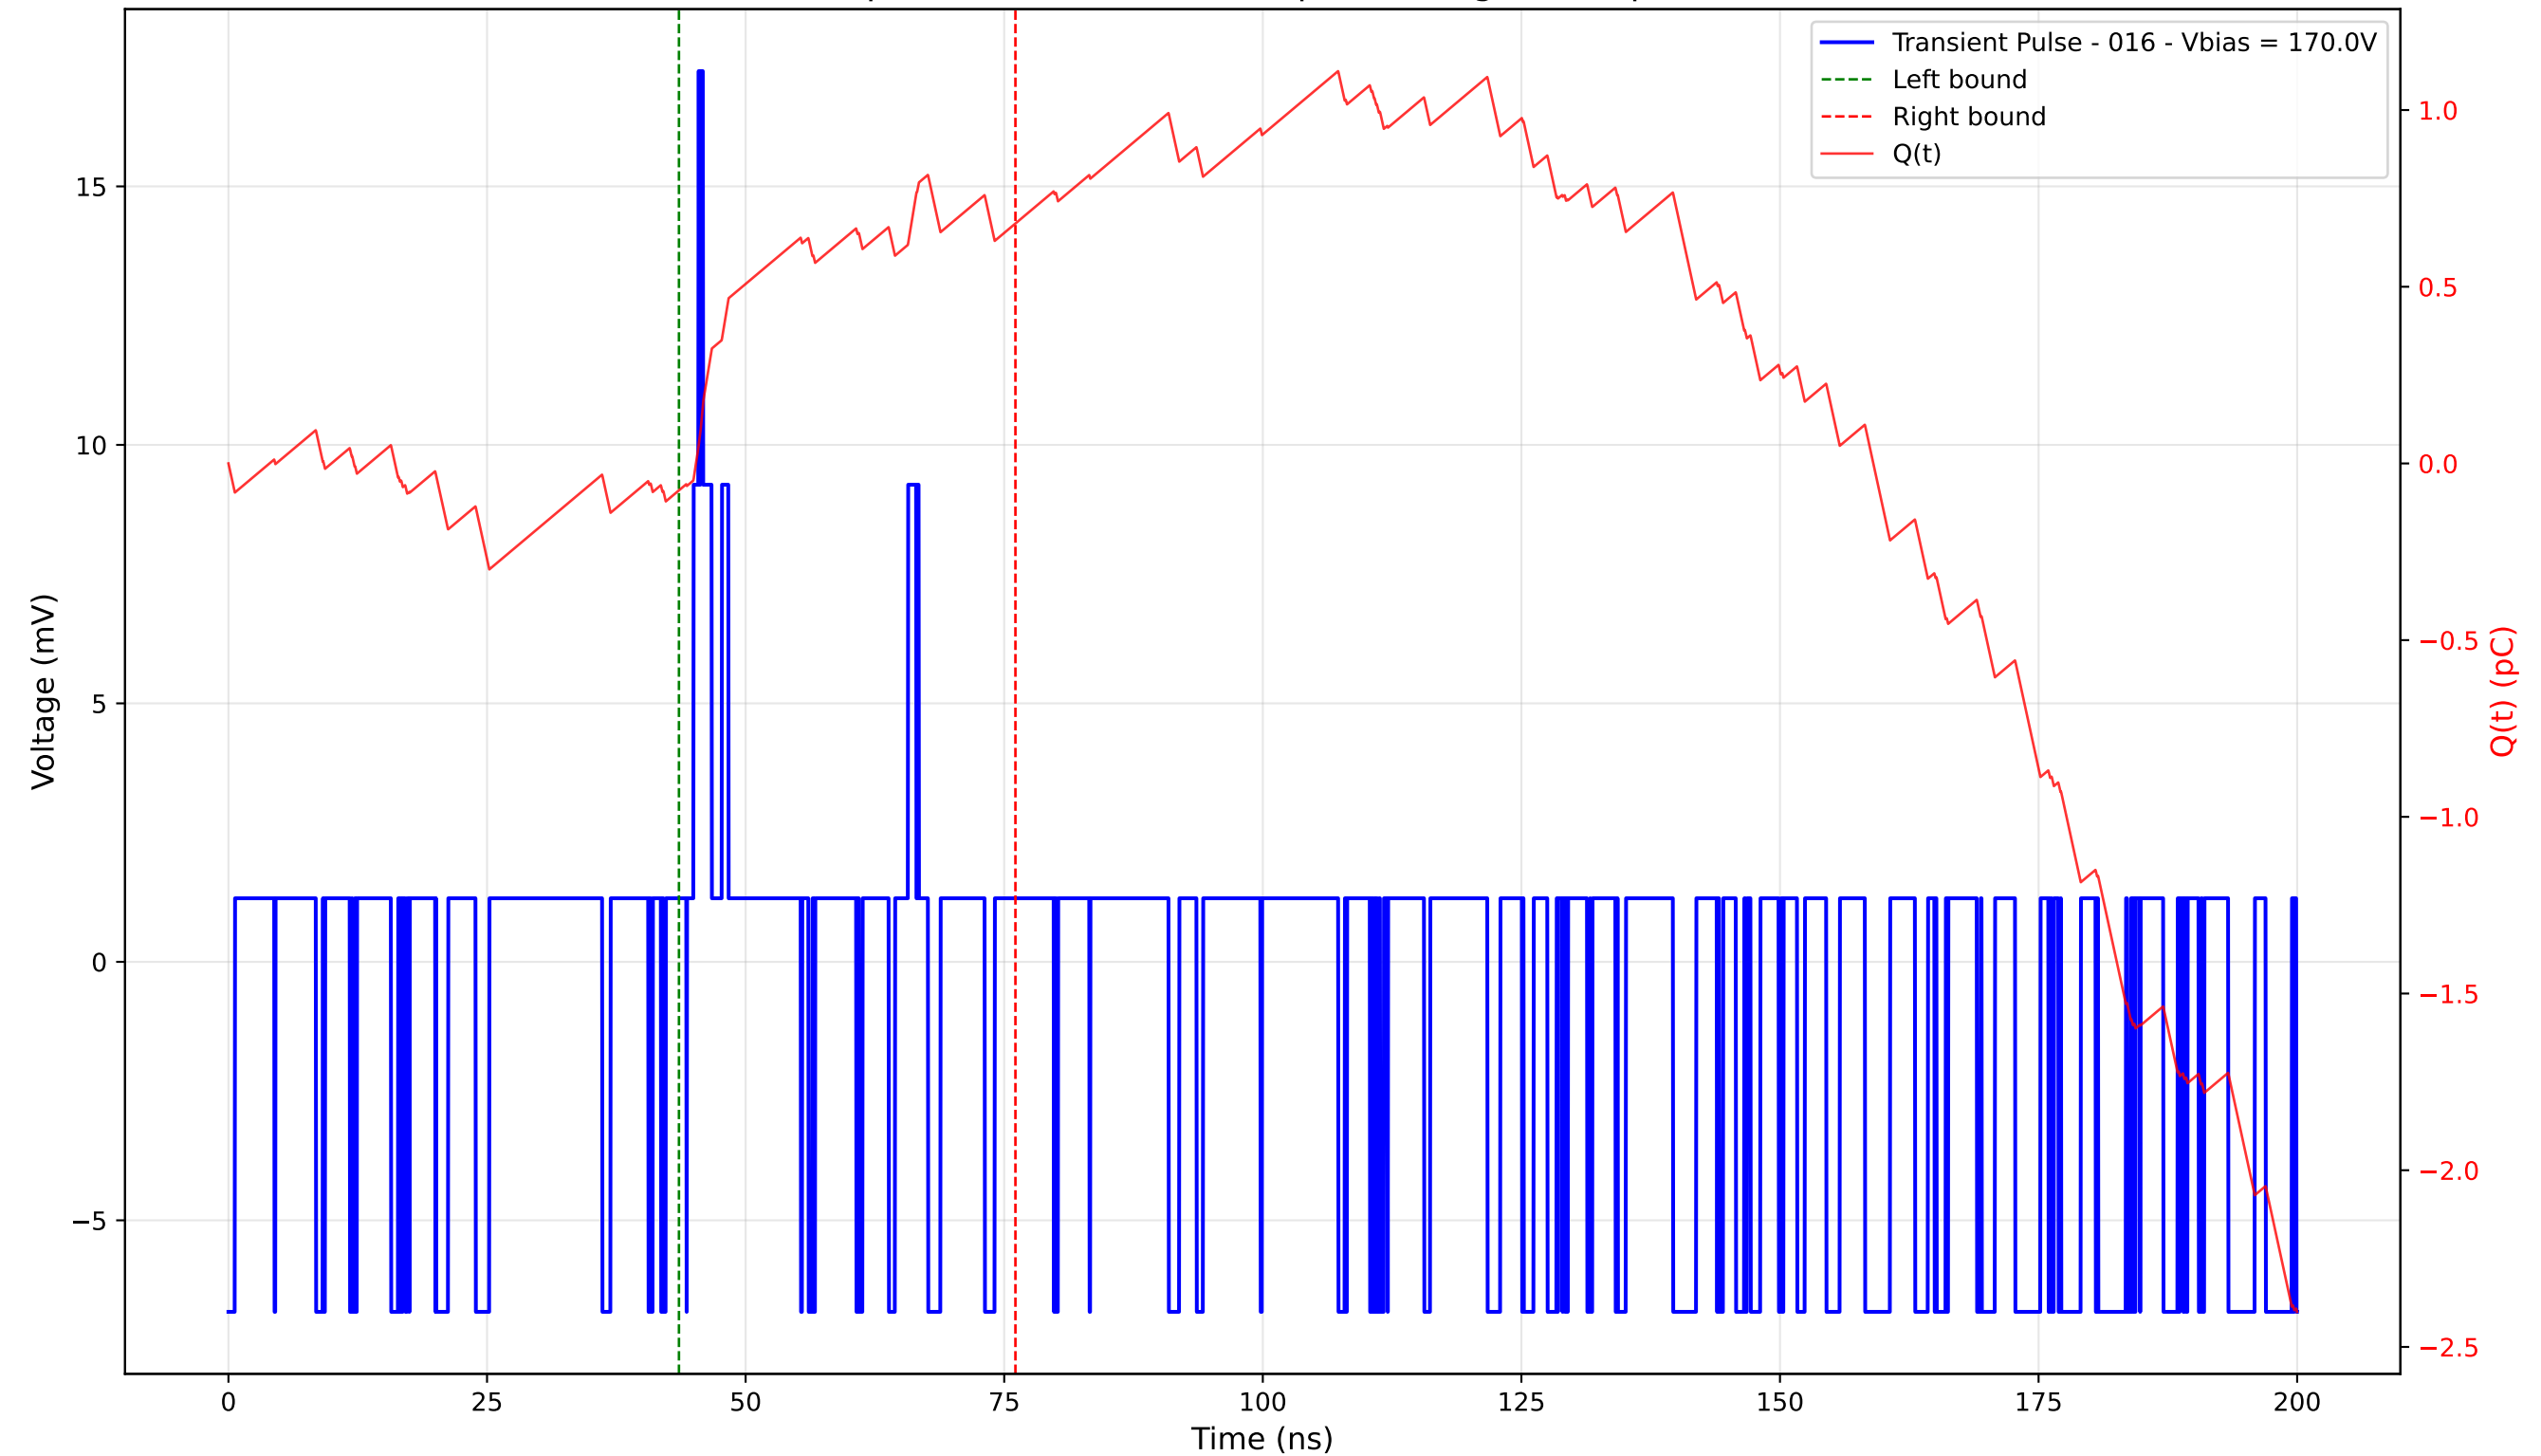


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 1.63 pC - Rise Time: 0.00 ns (N/A)

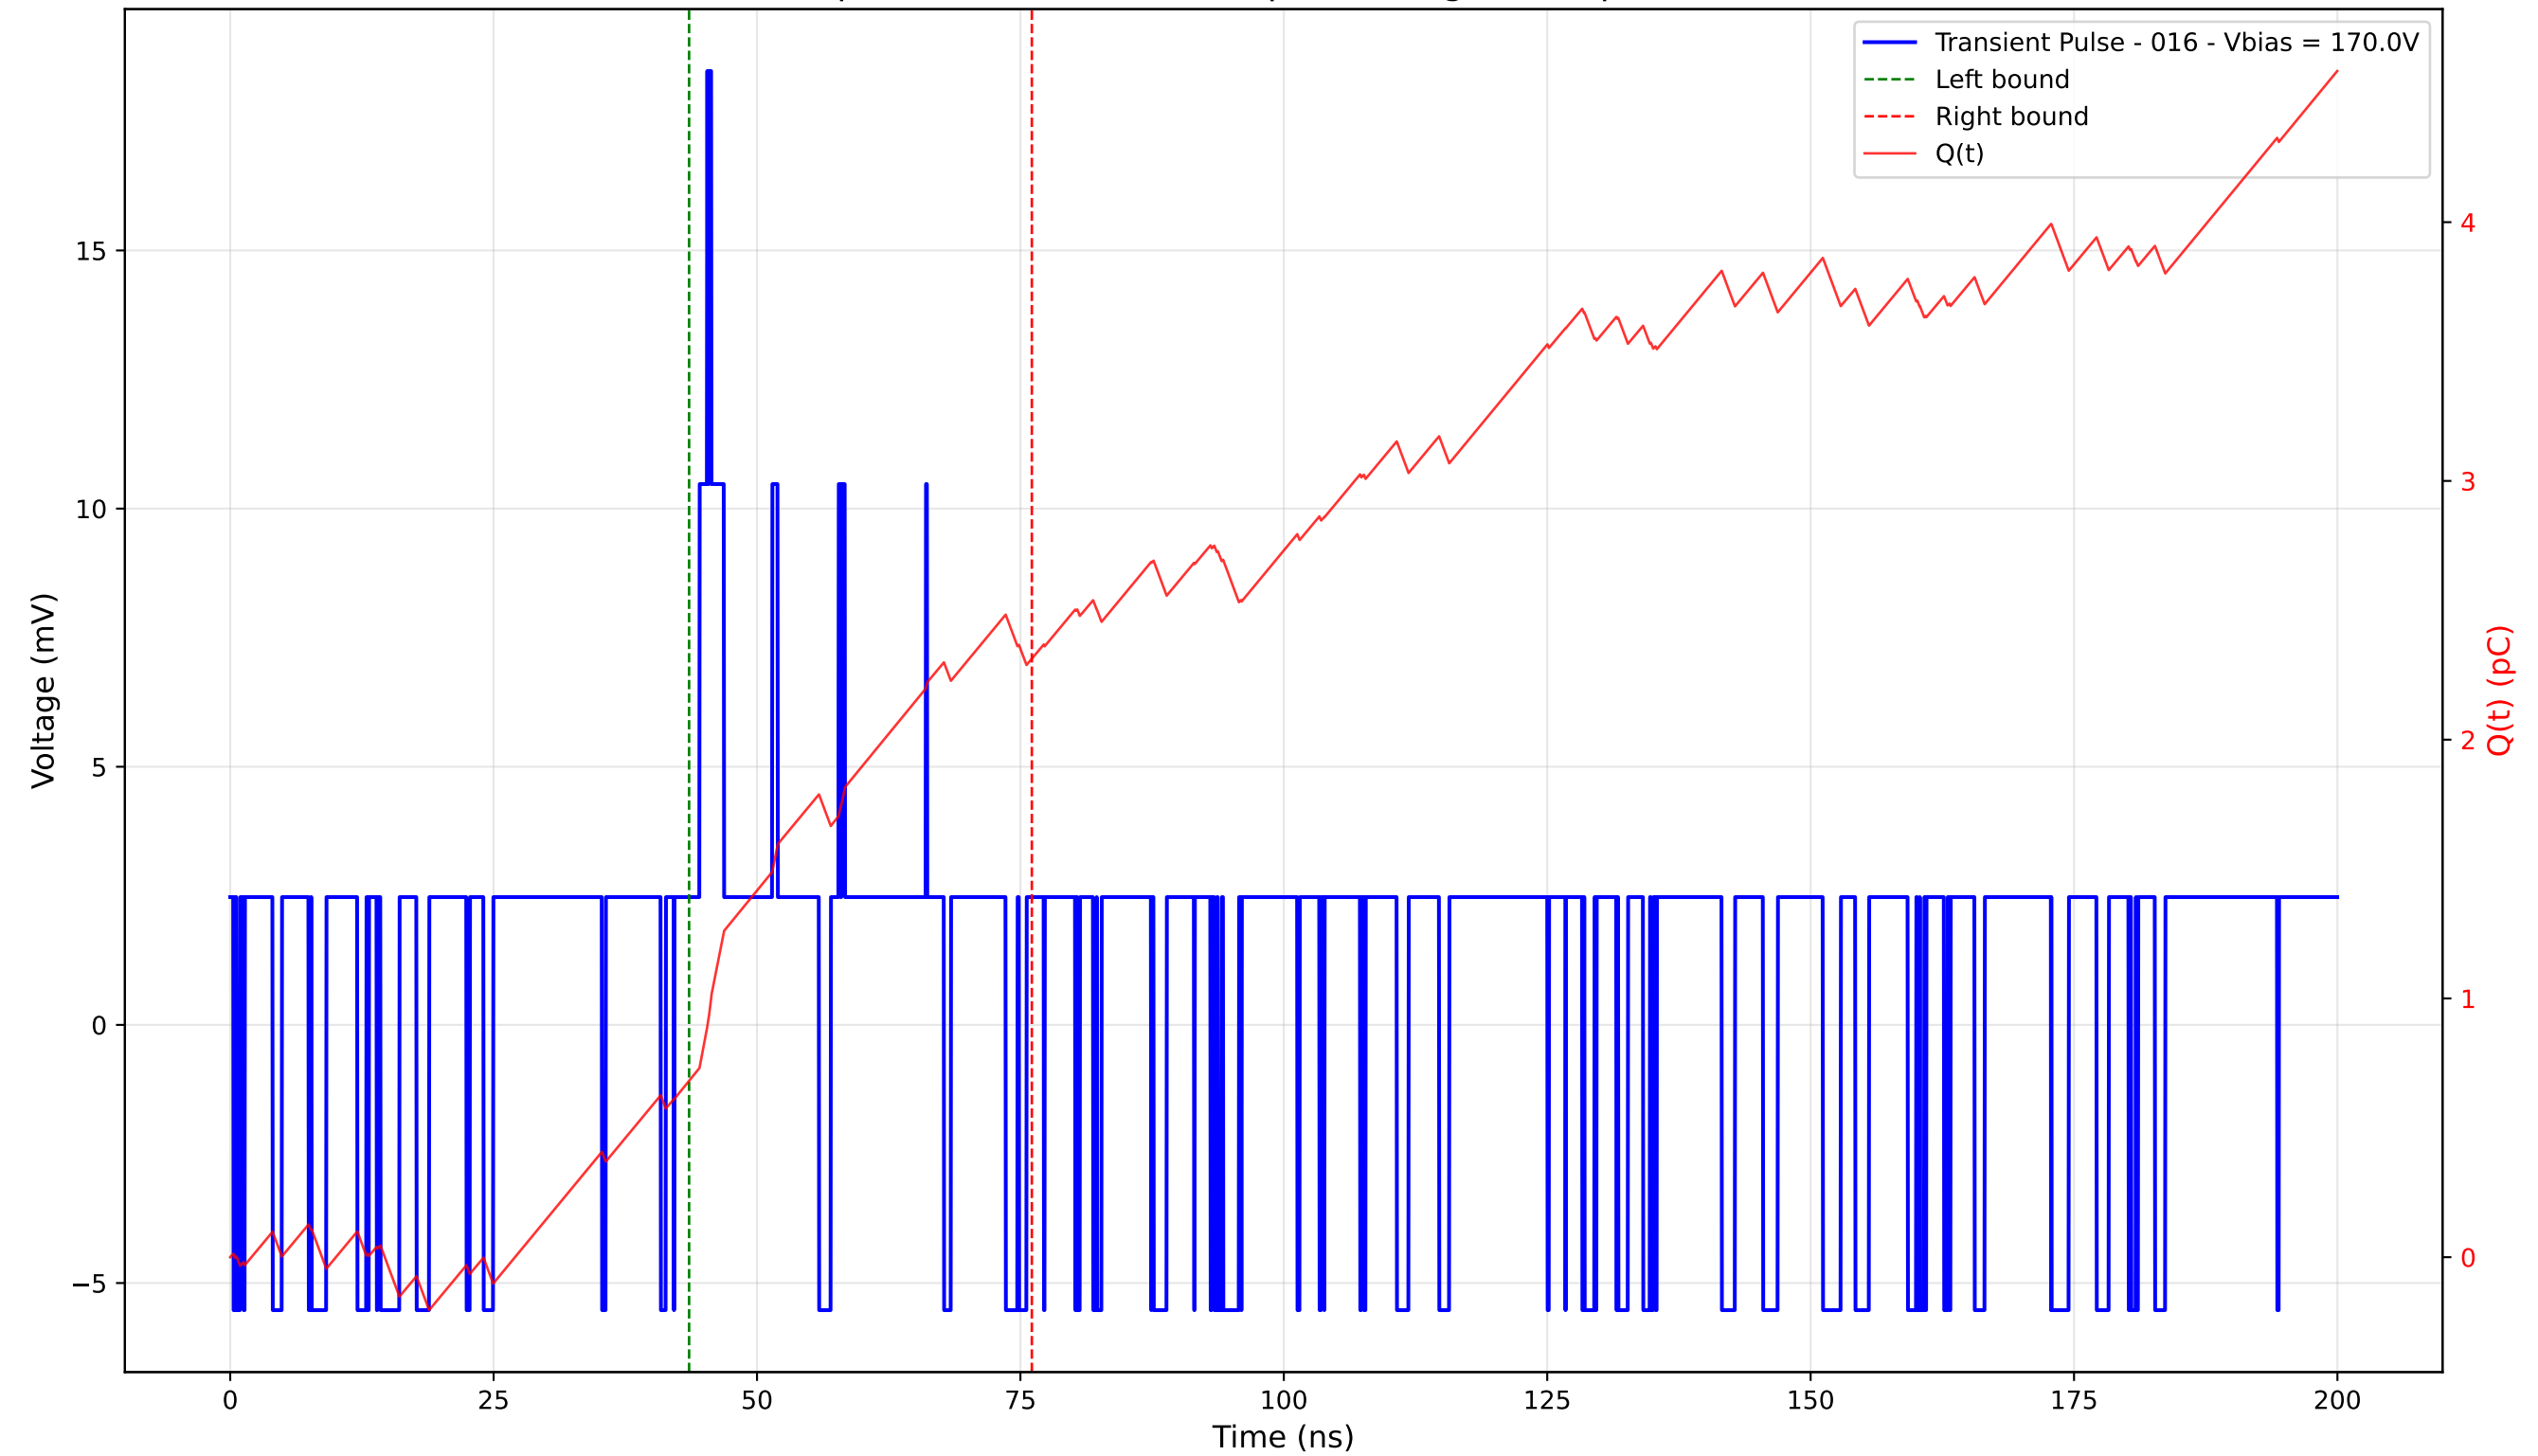


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 1.16 pC - Rise Time: 0.58 ns

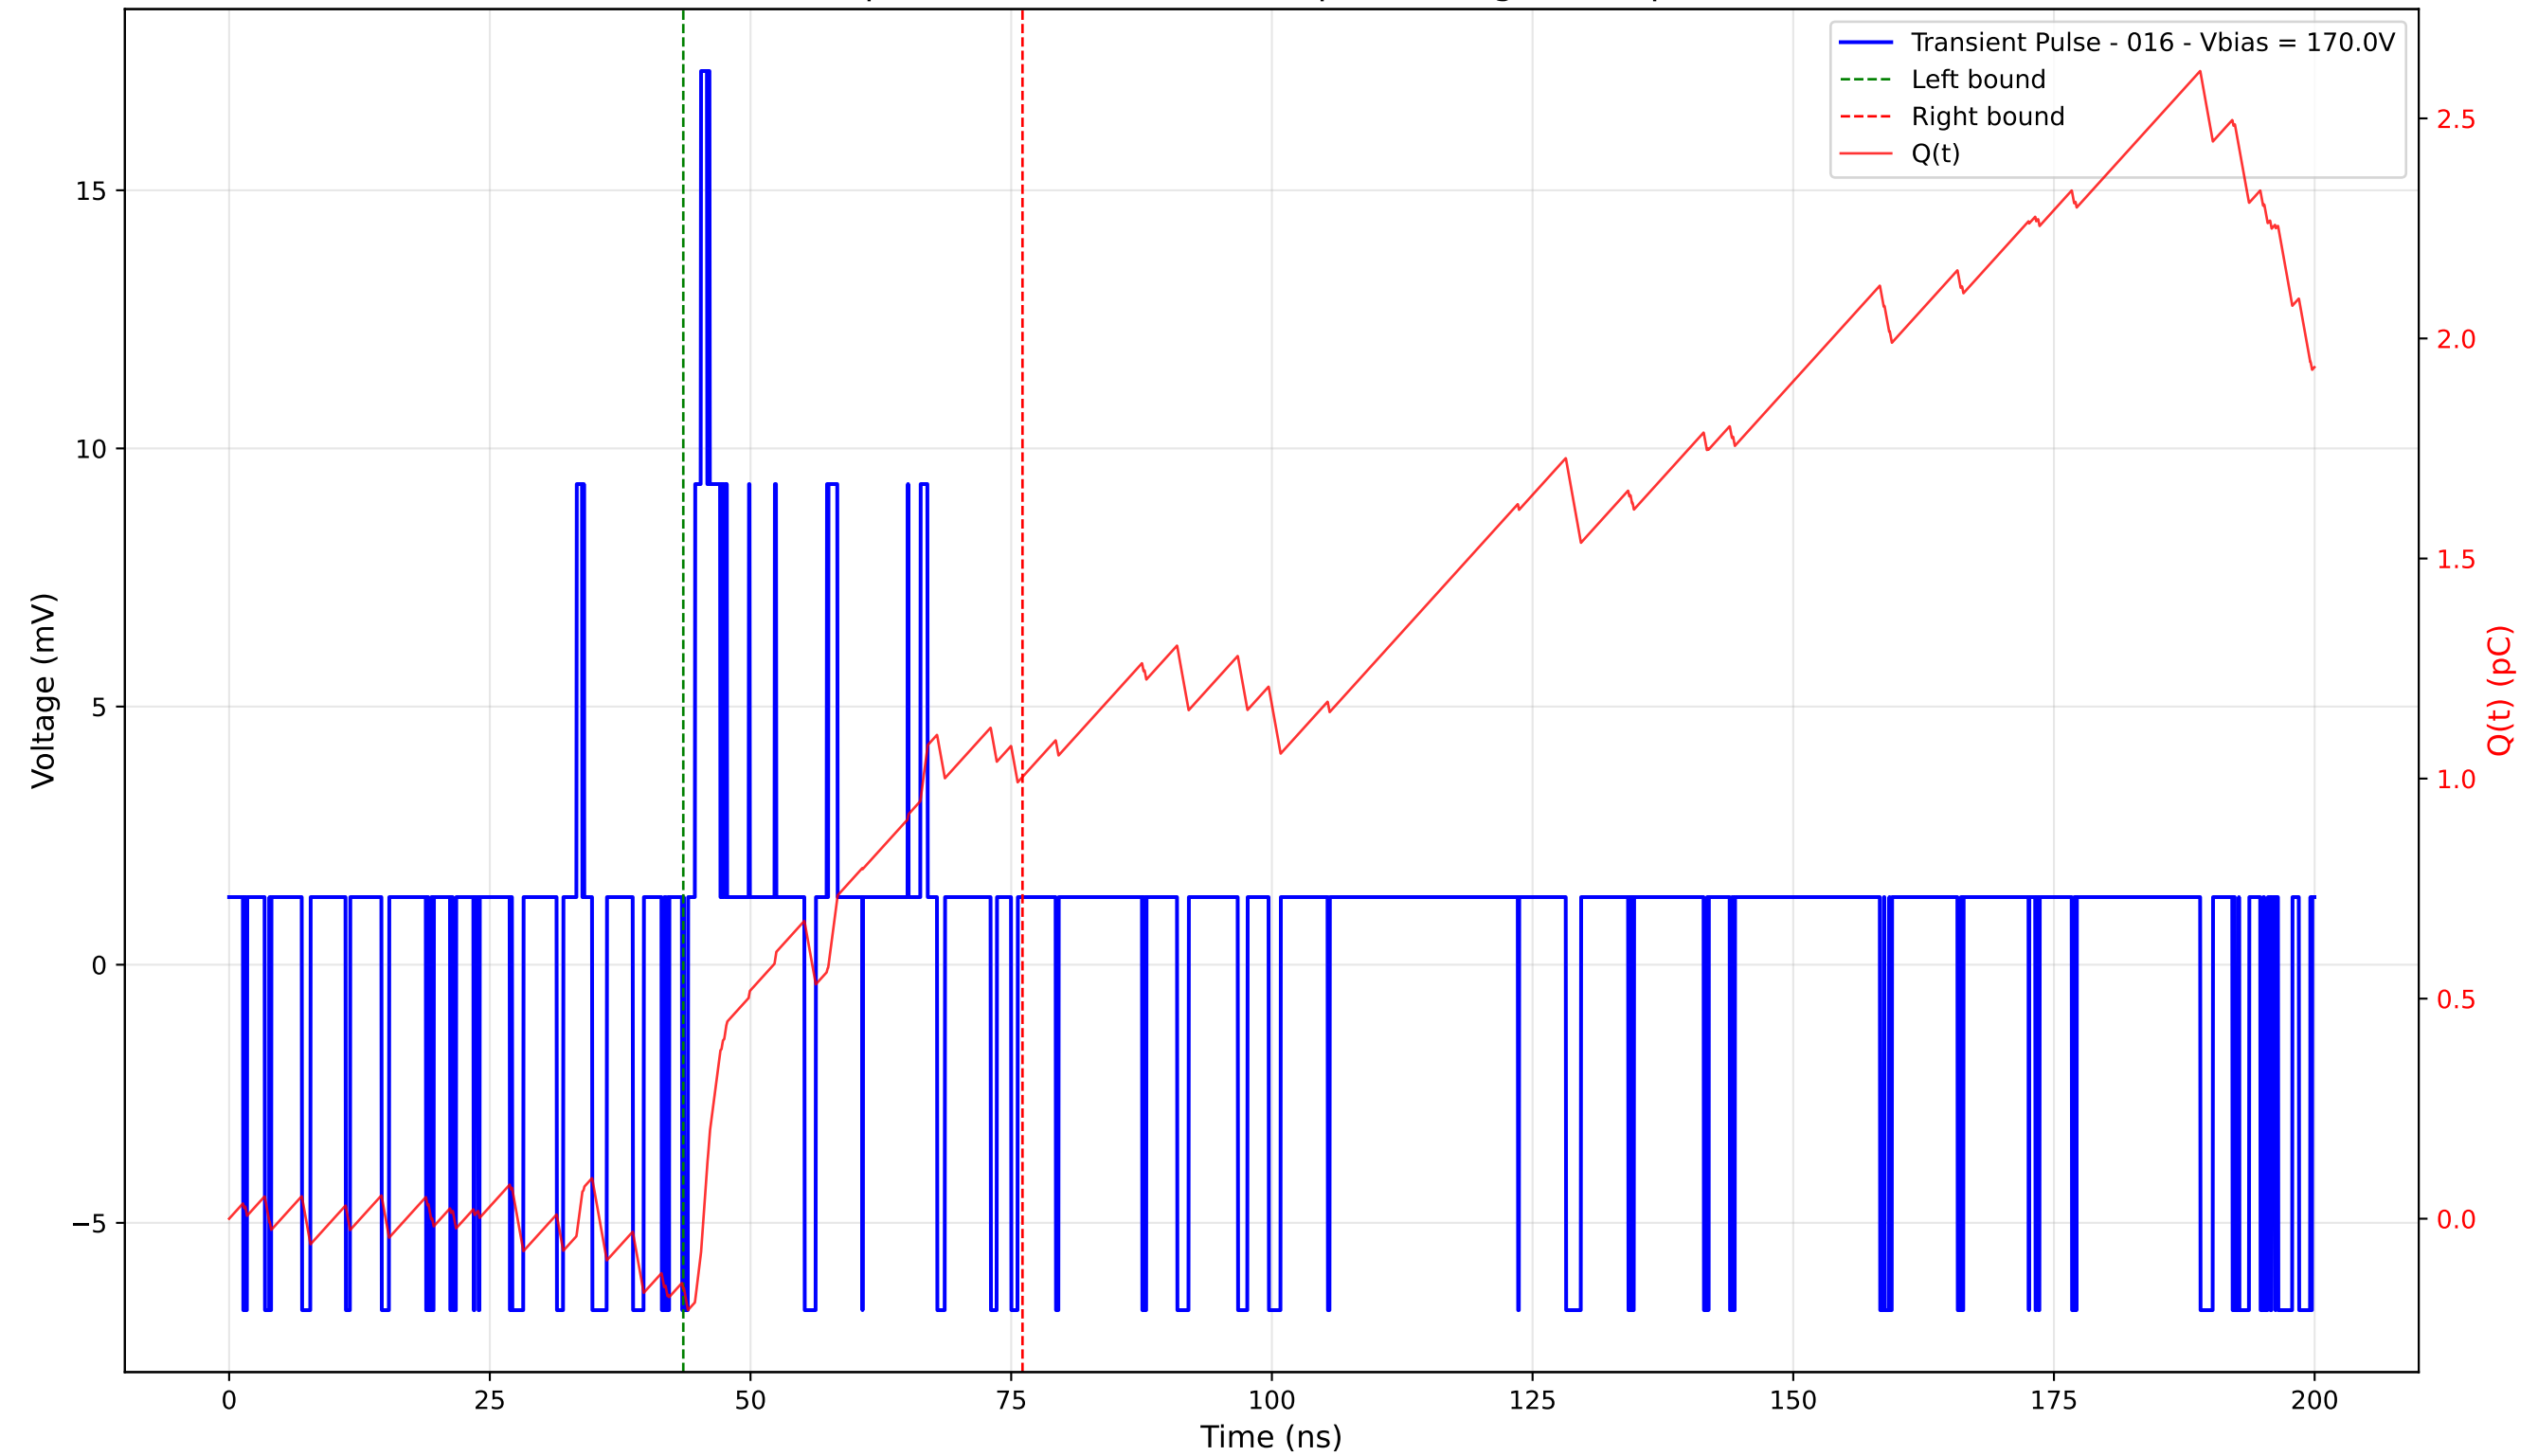


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 2.85 pC - Rise Time: 0.00 ns (N/A)

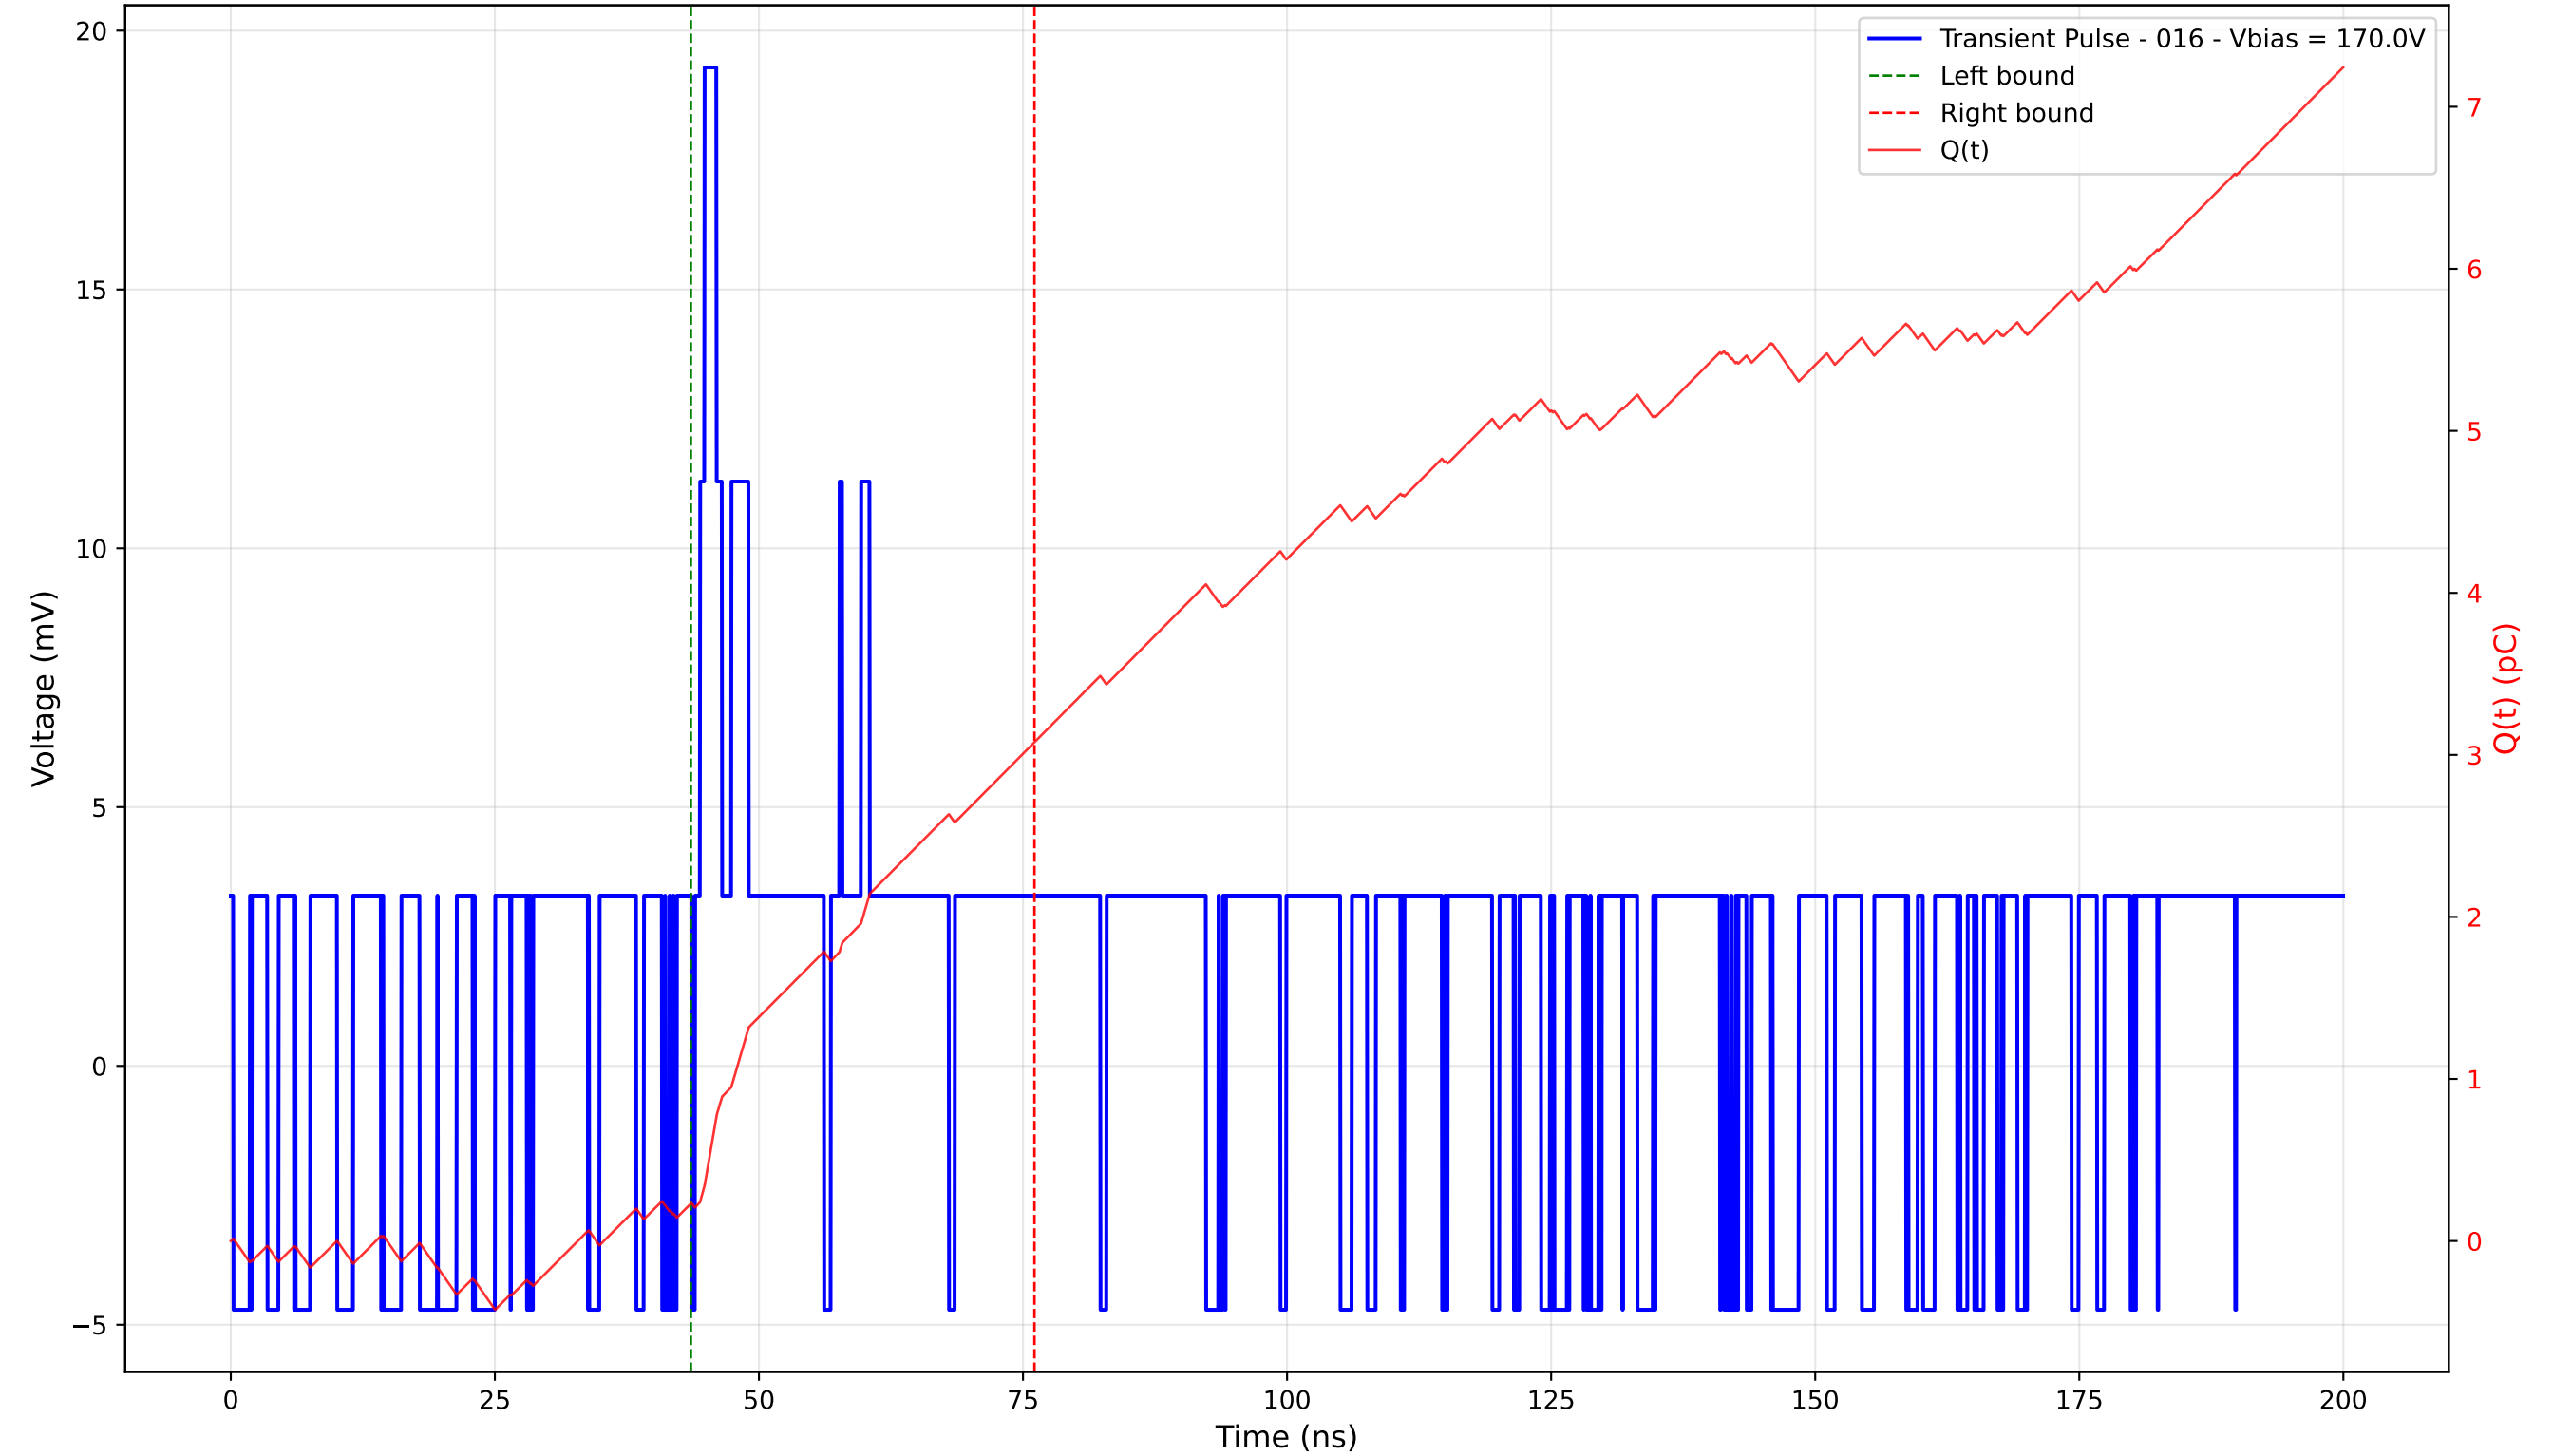


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 0.87 pC - Rise Time: 0.00 ns (N/A)

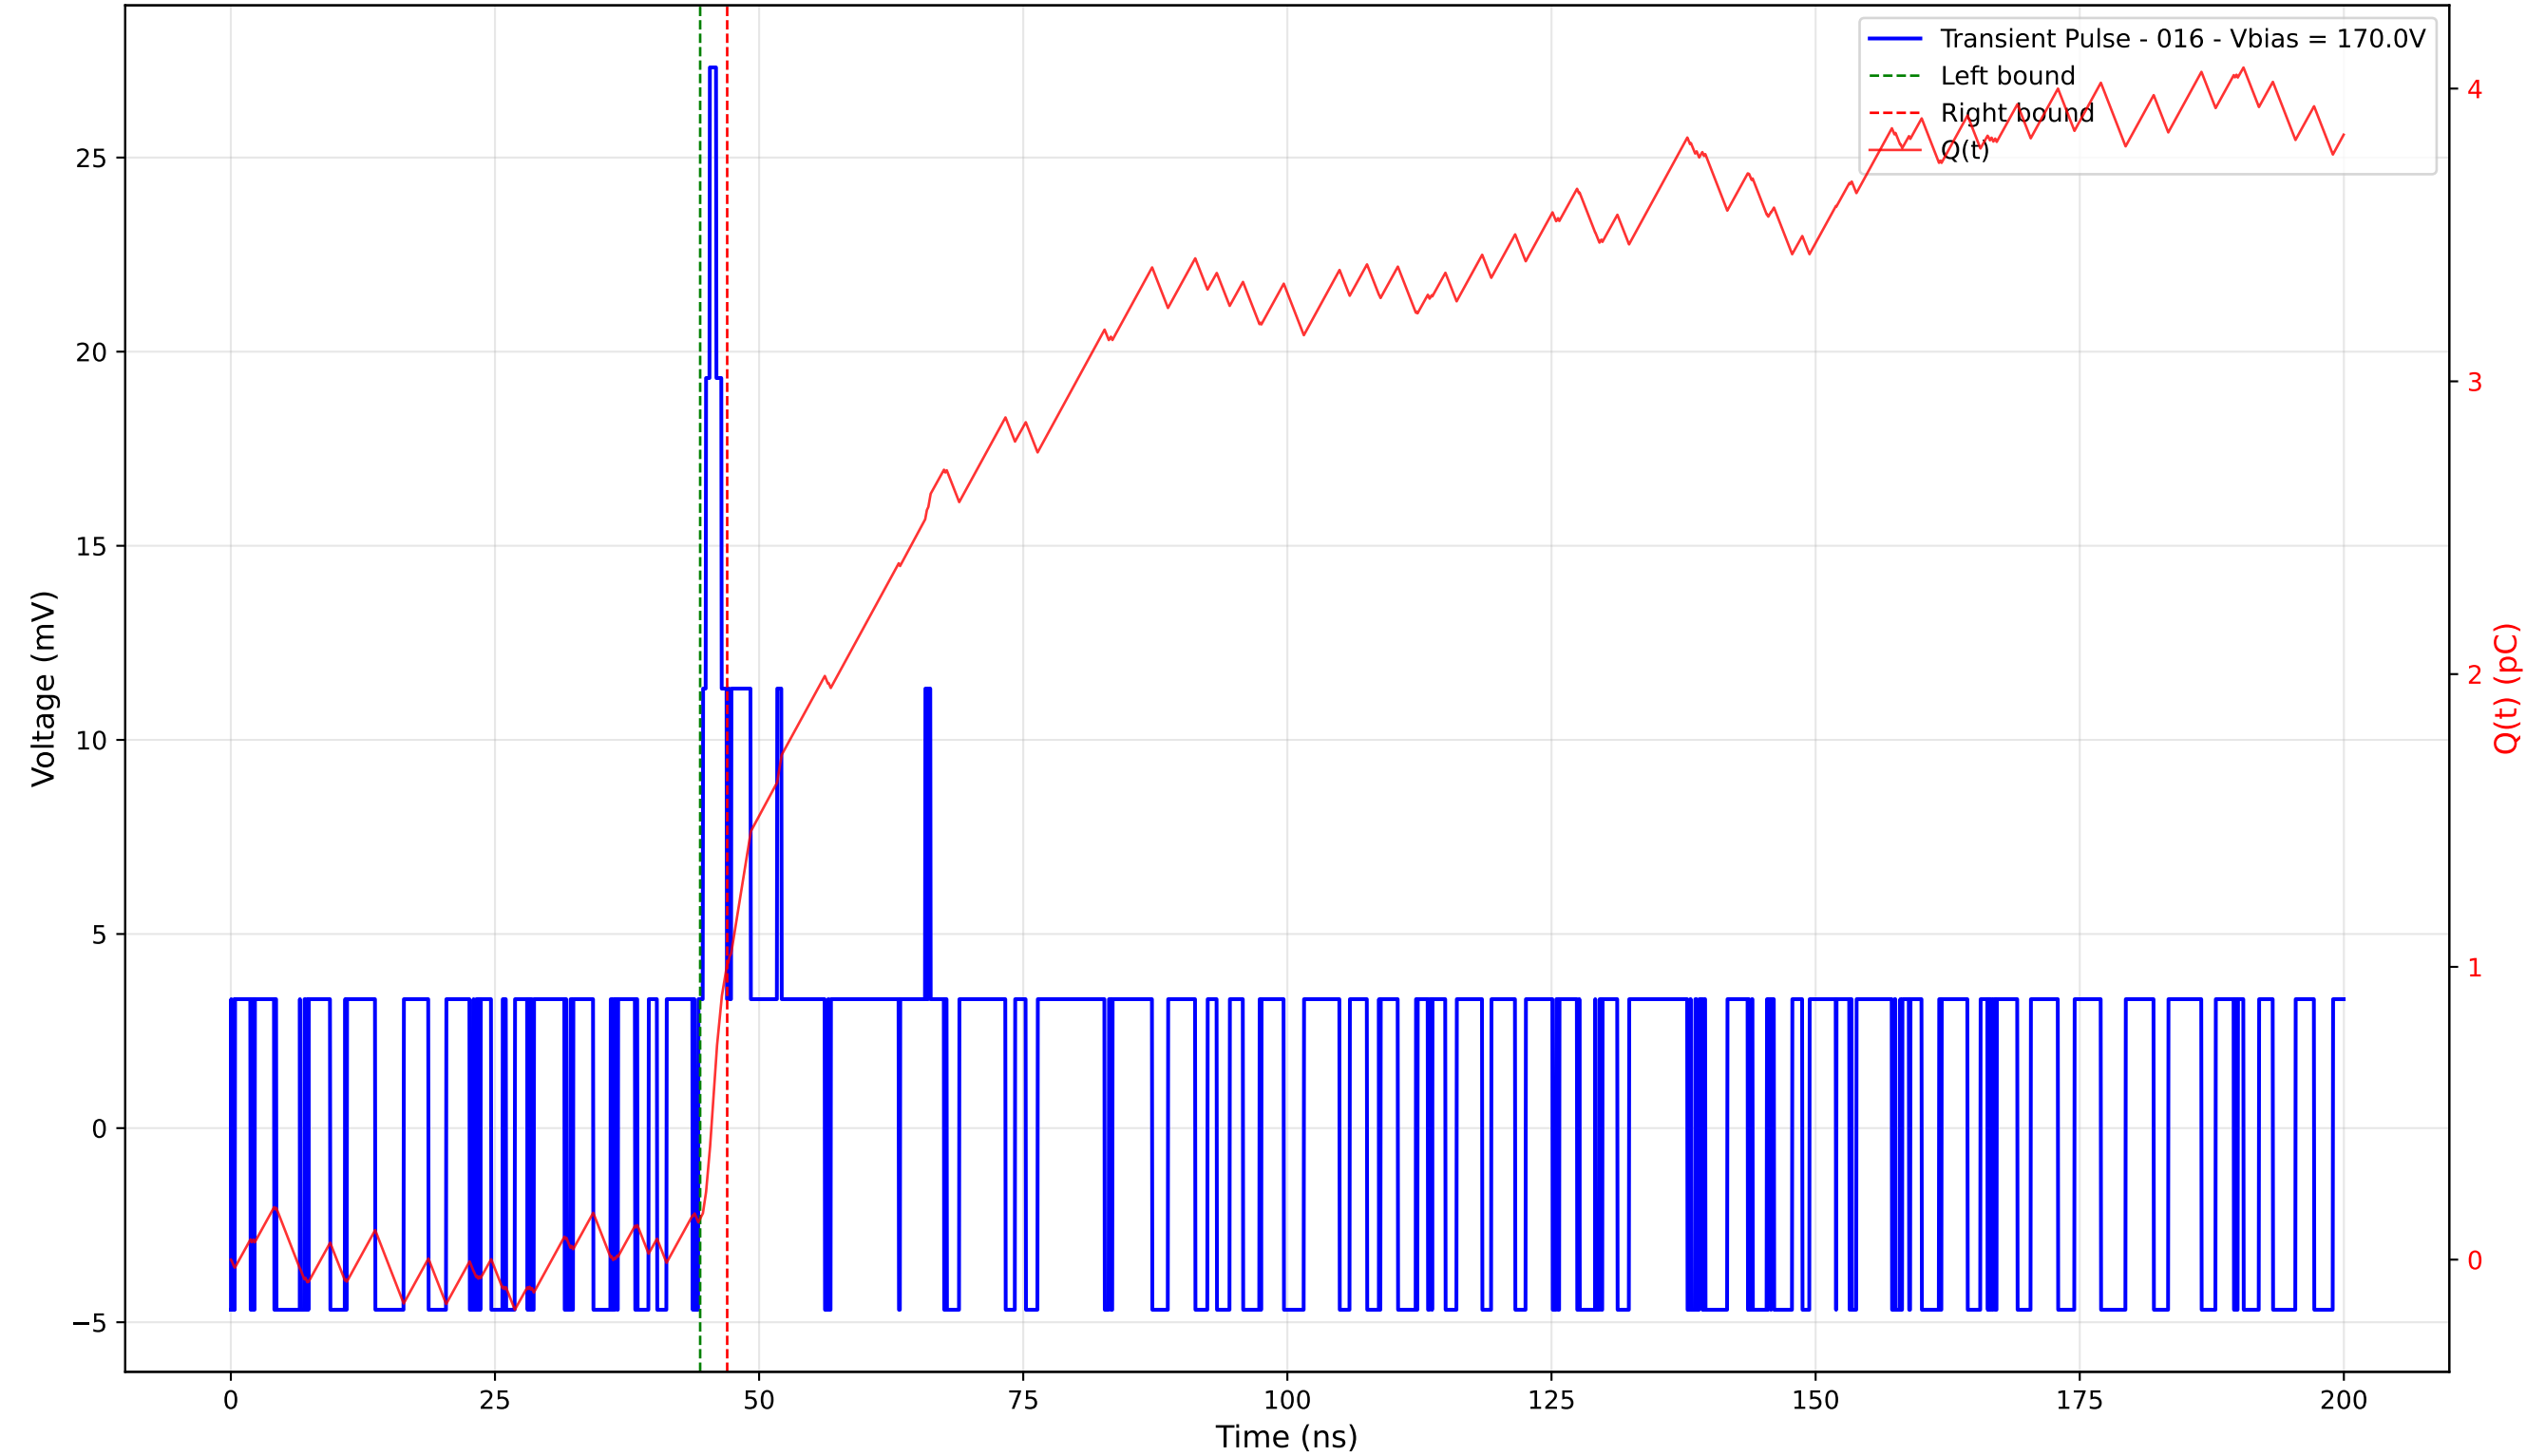


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.11 pC - Rise Time: 0.76 ns

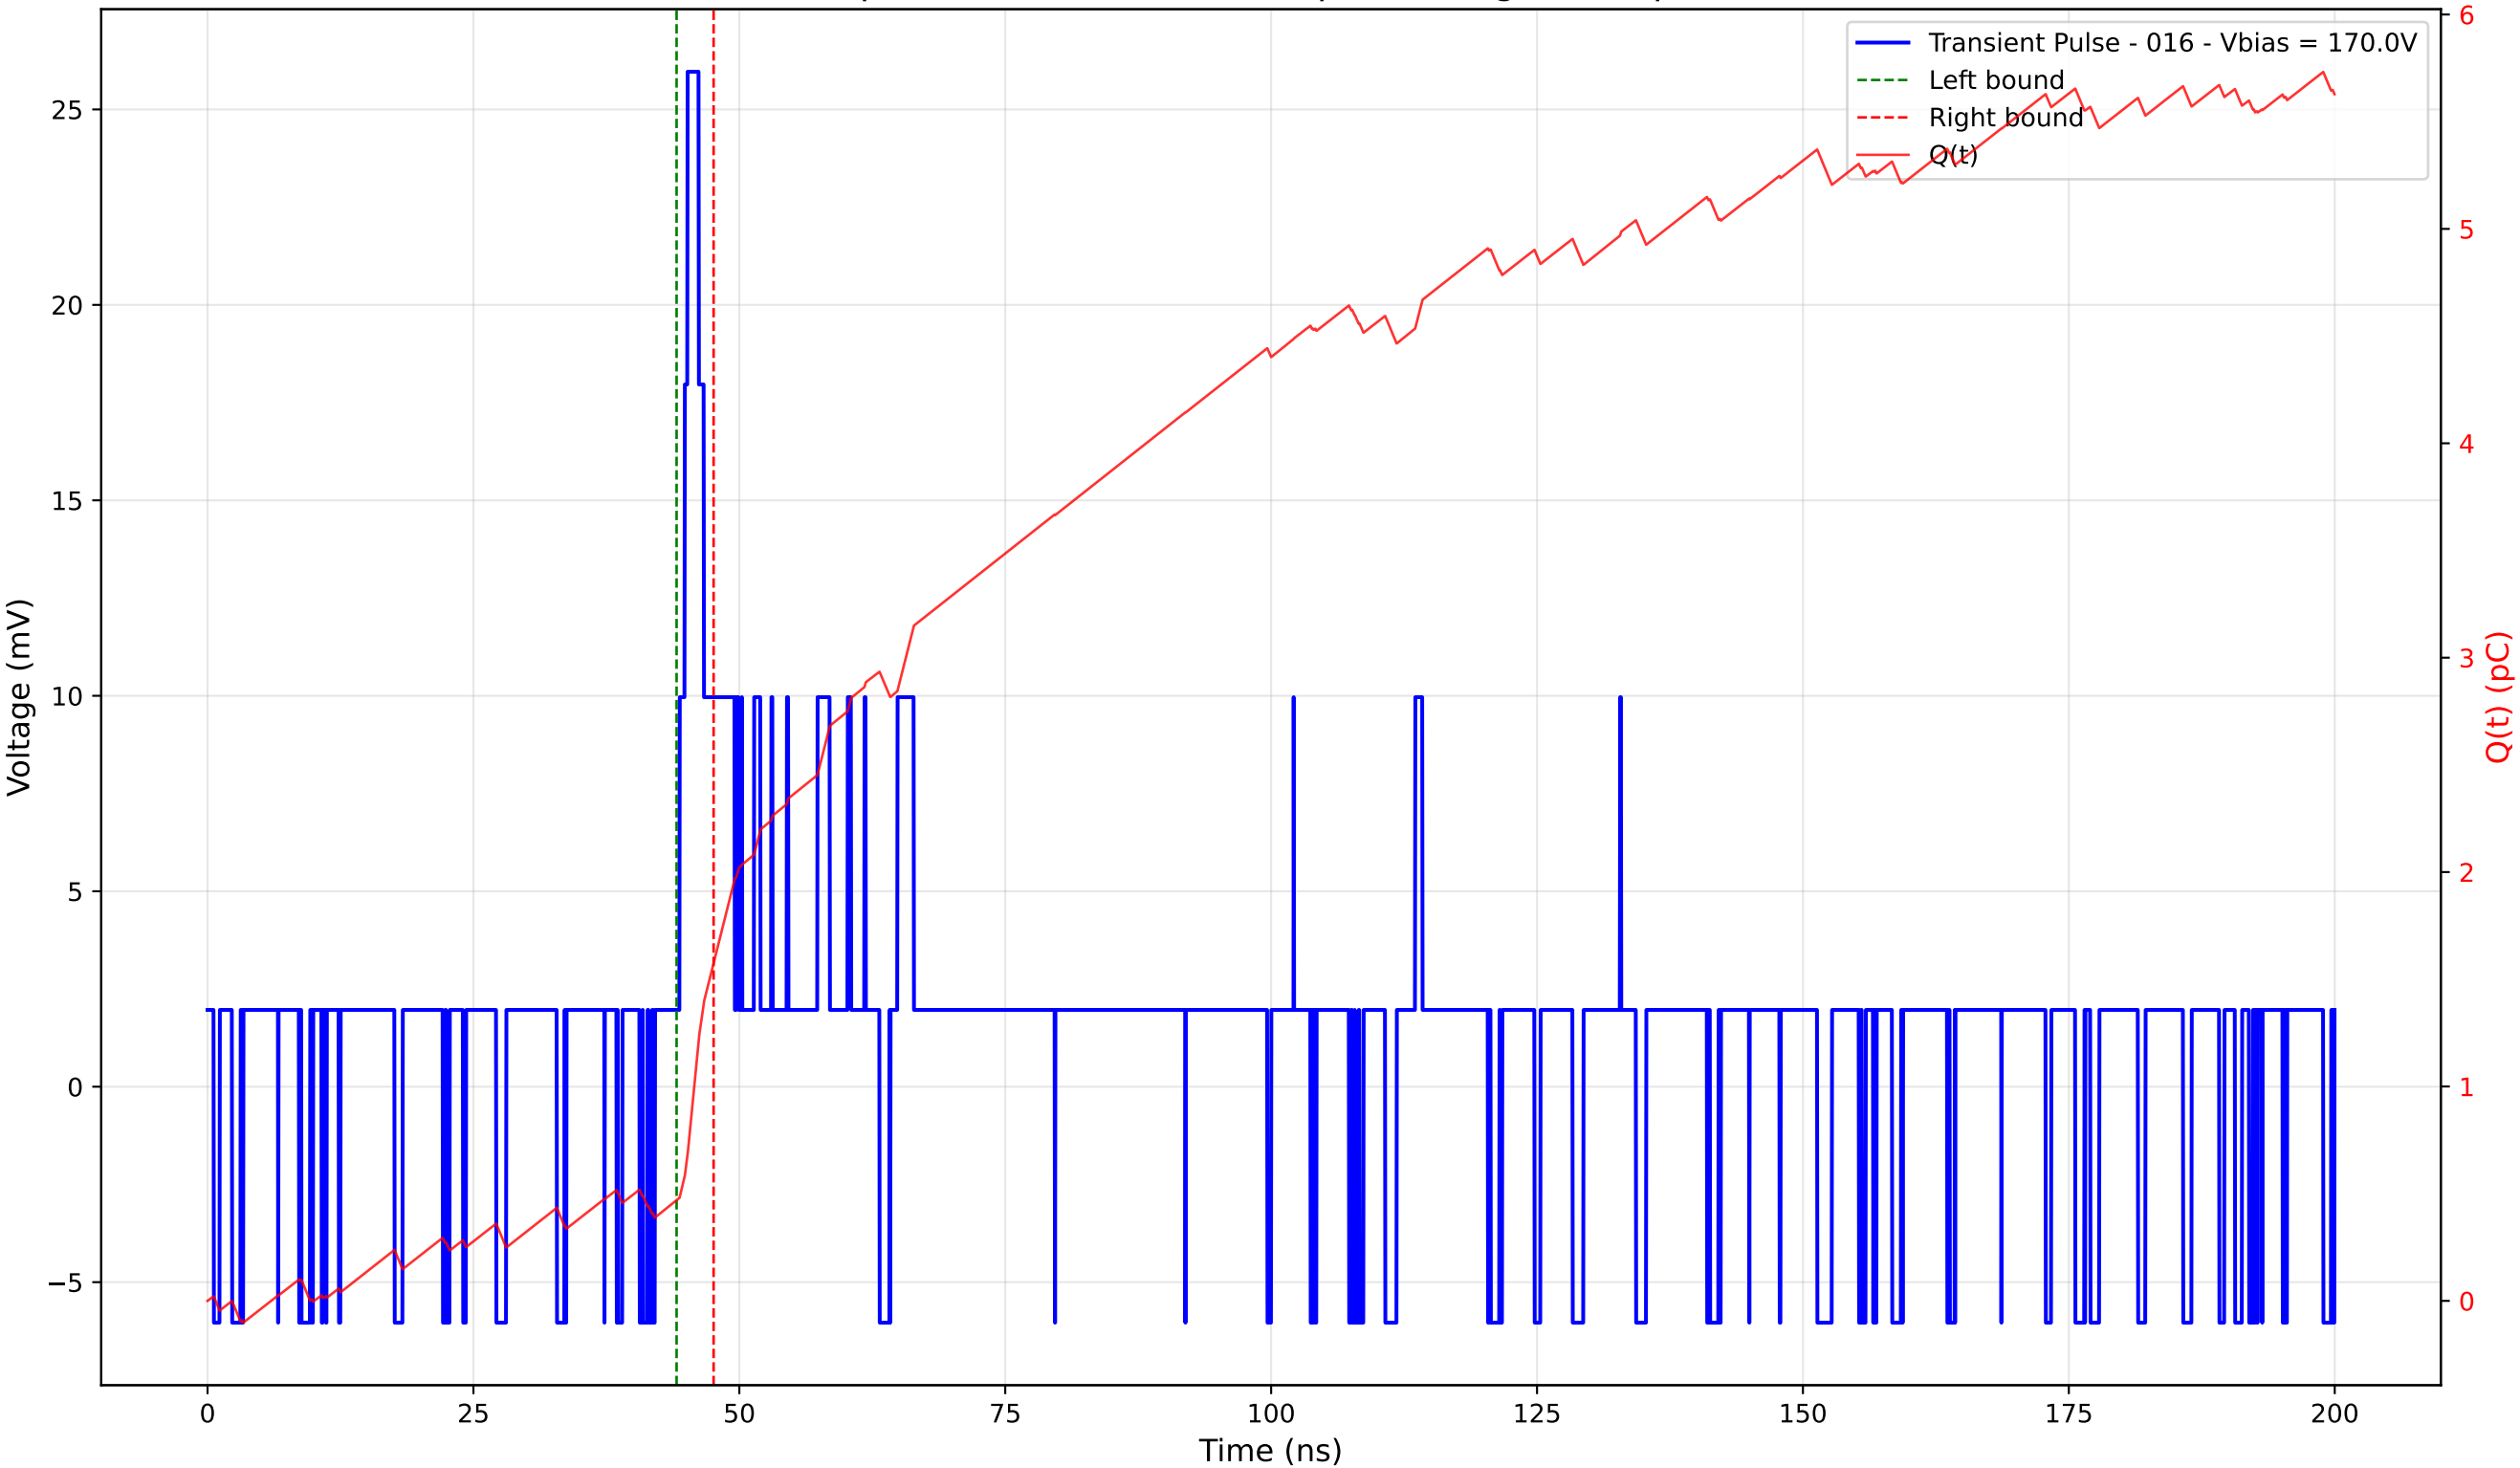


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.24 pC - Rise Time: 0.74 ns

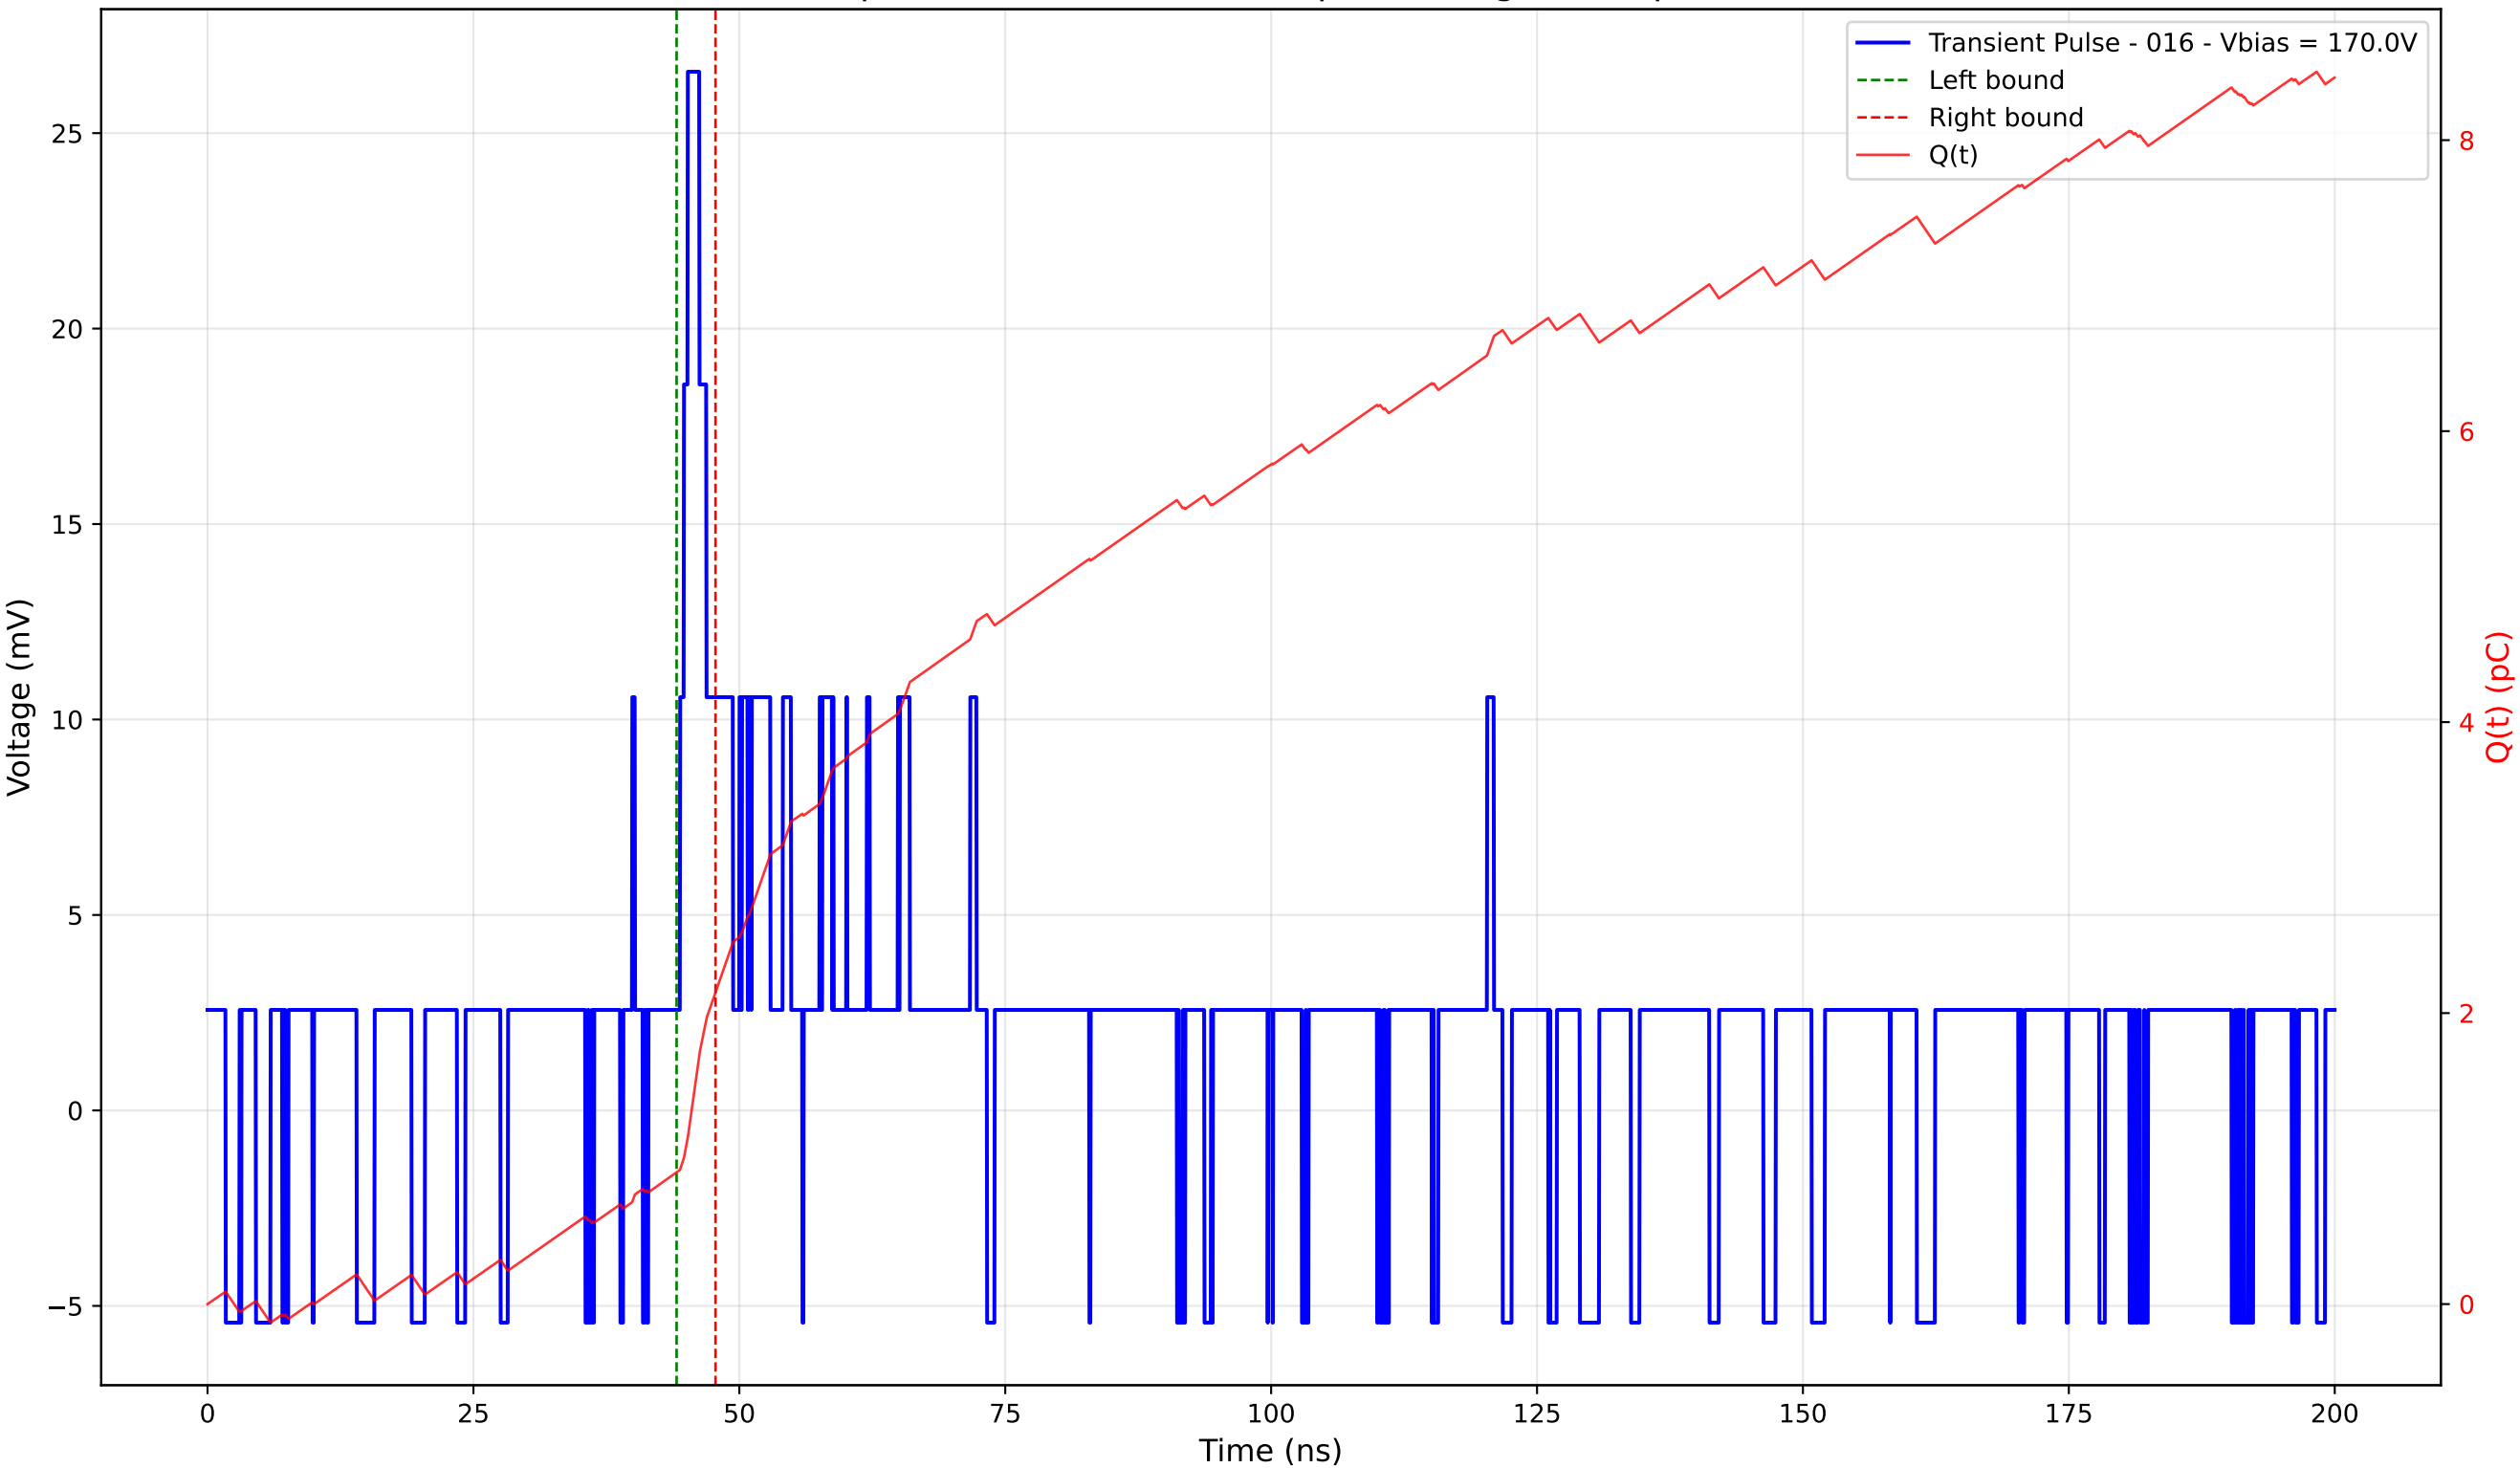


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.15 pC - Rise Time: 0.72 ns

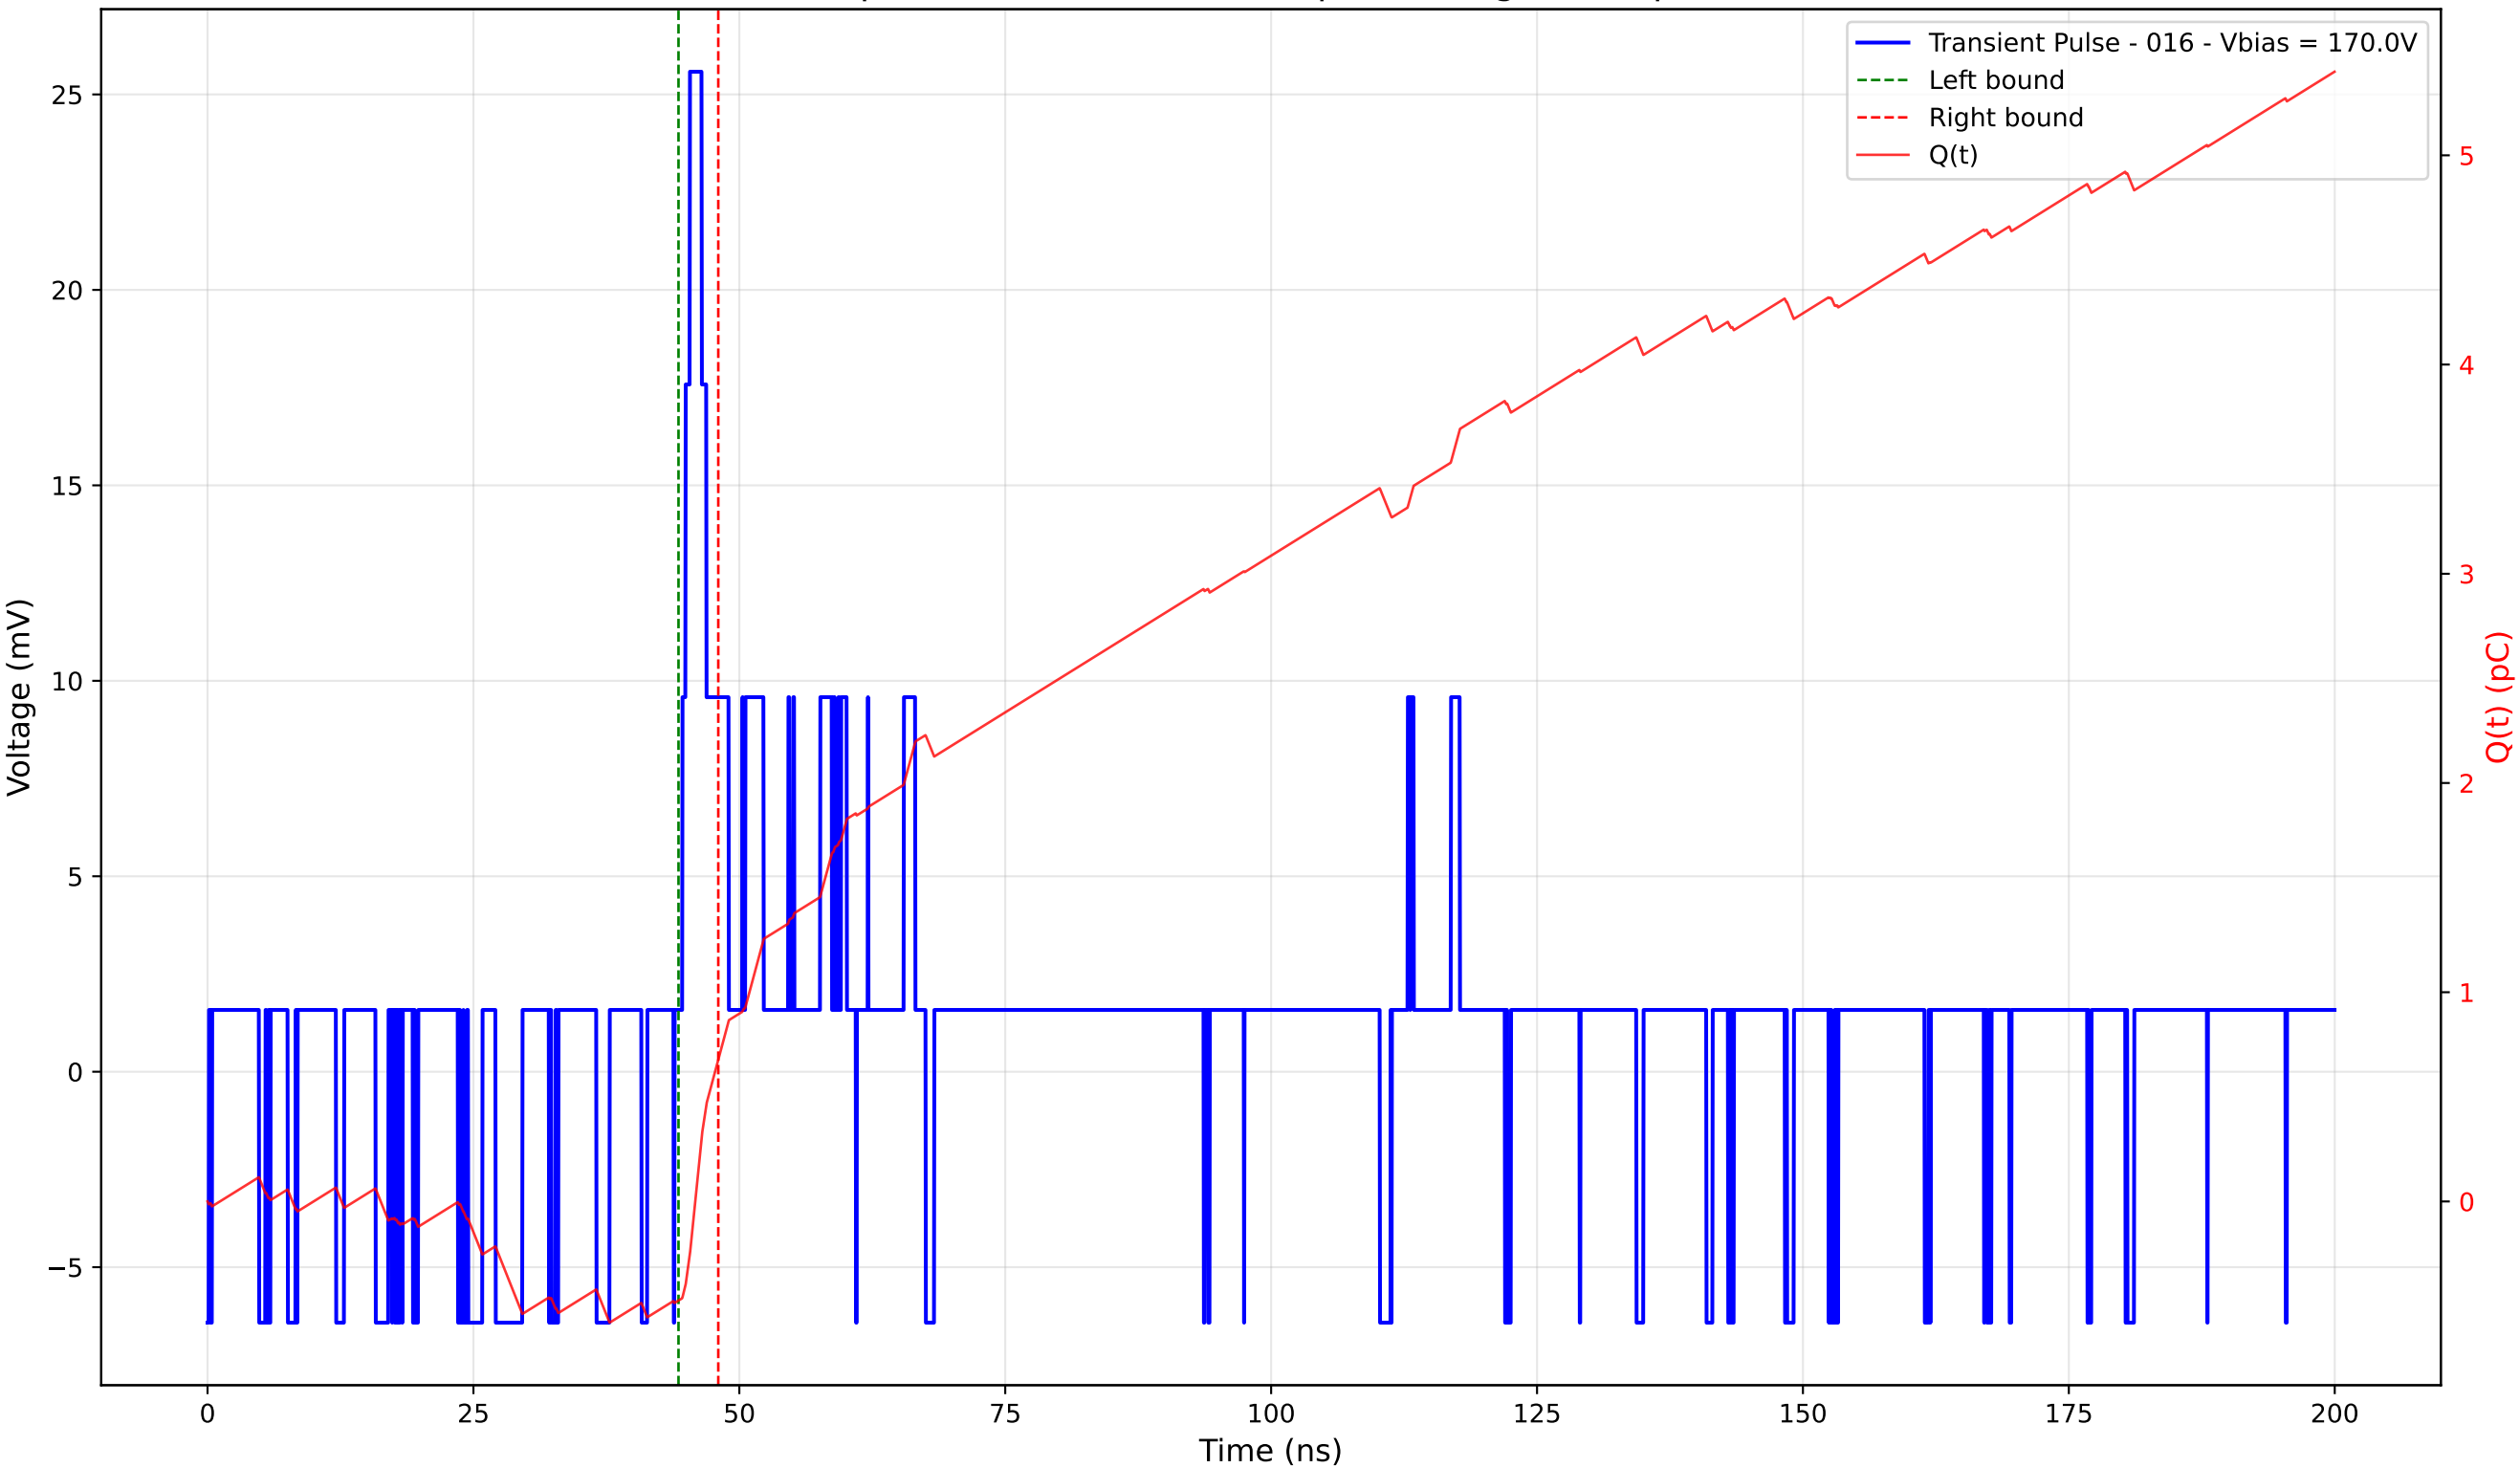


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.90 pC - Rise Time: 1.35 ns

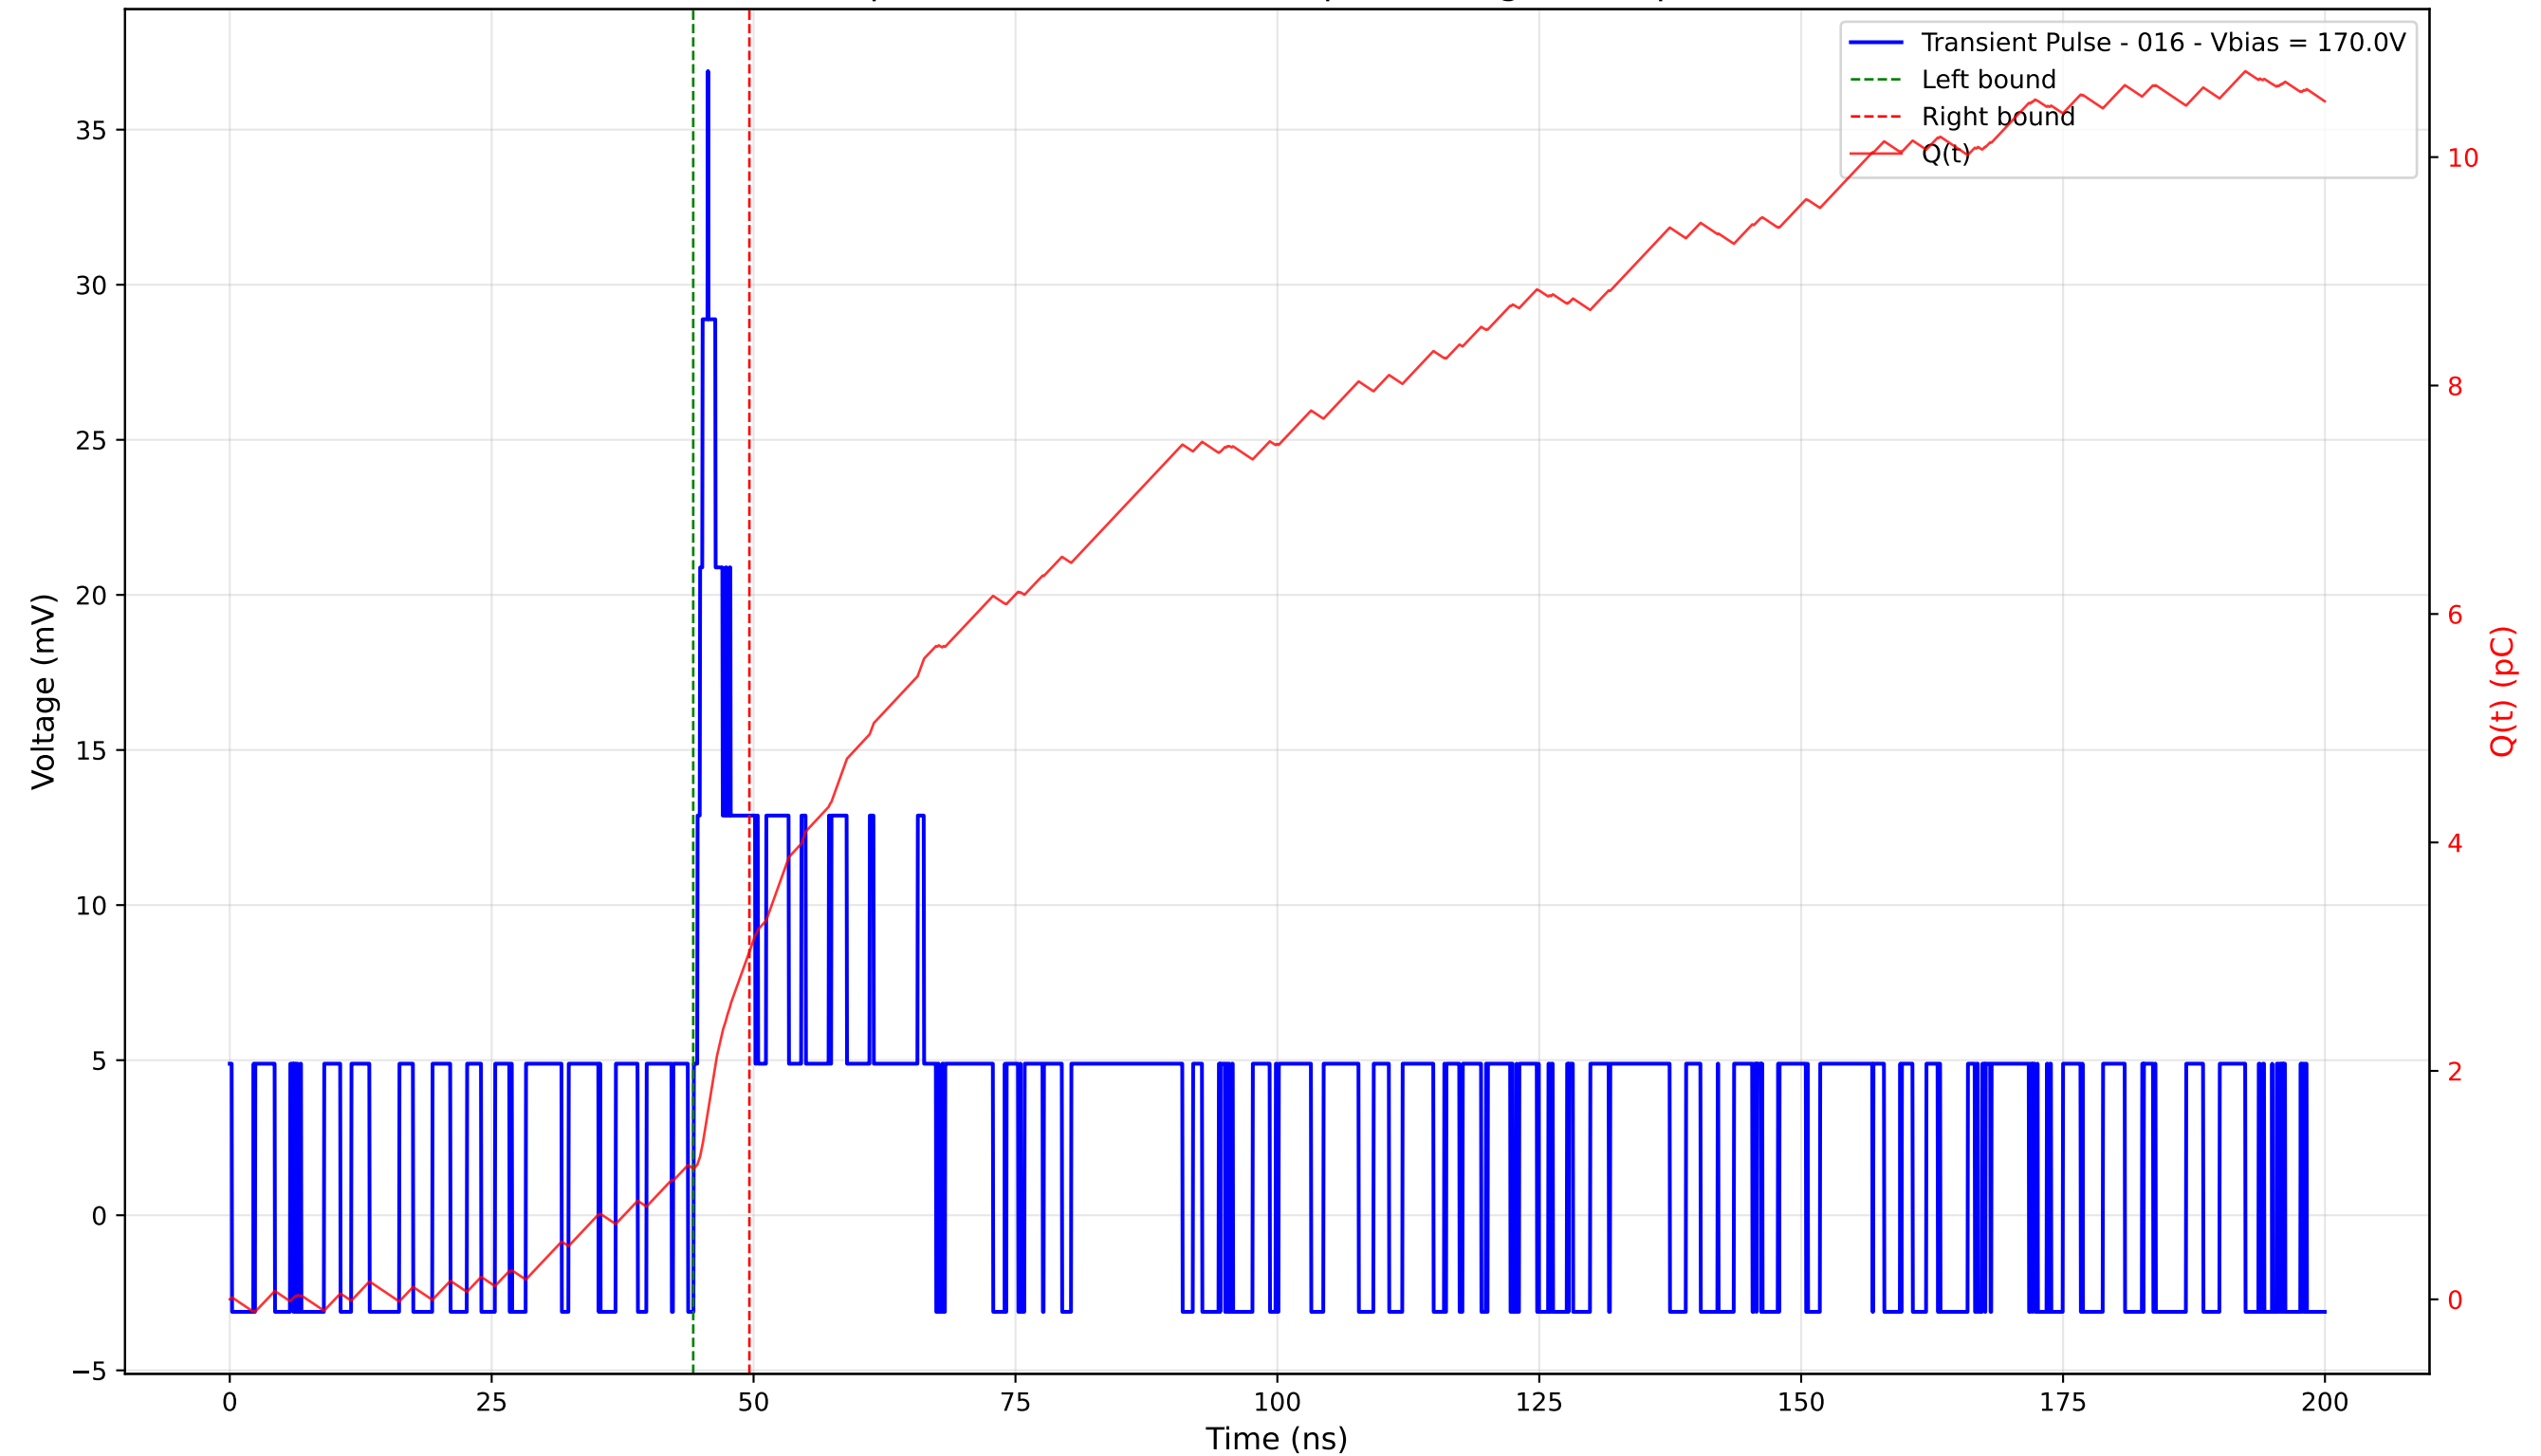


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.28 pC - Rise Time: 0.82 ns

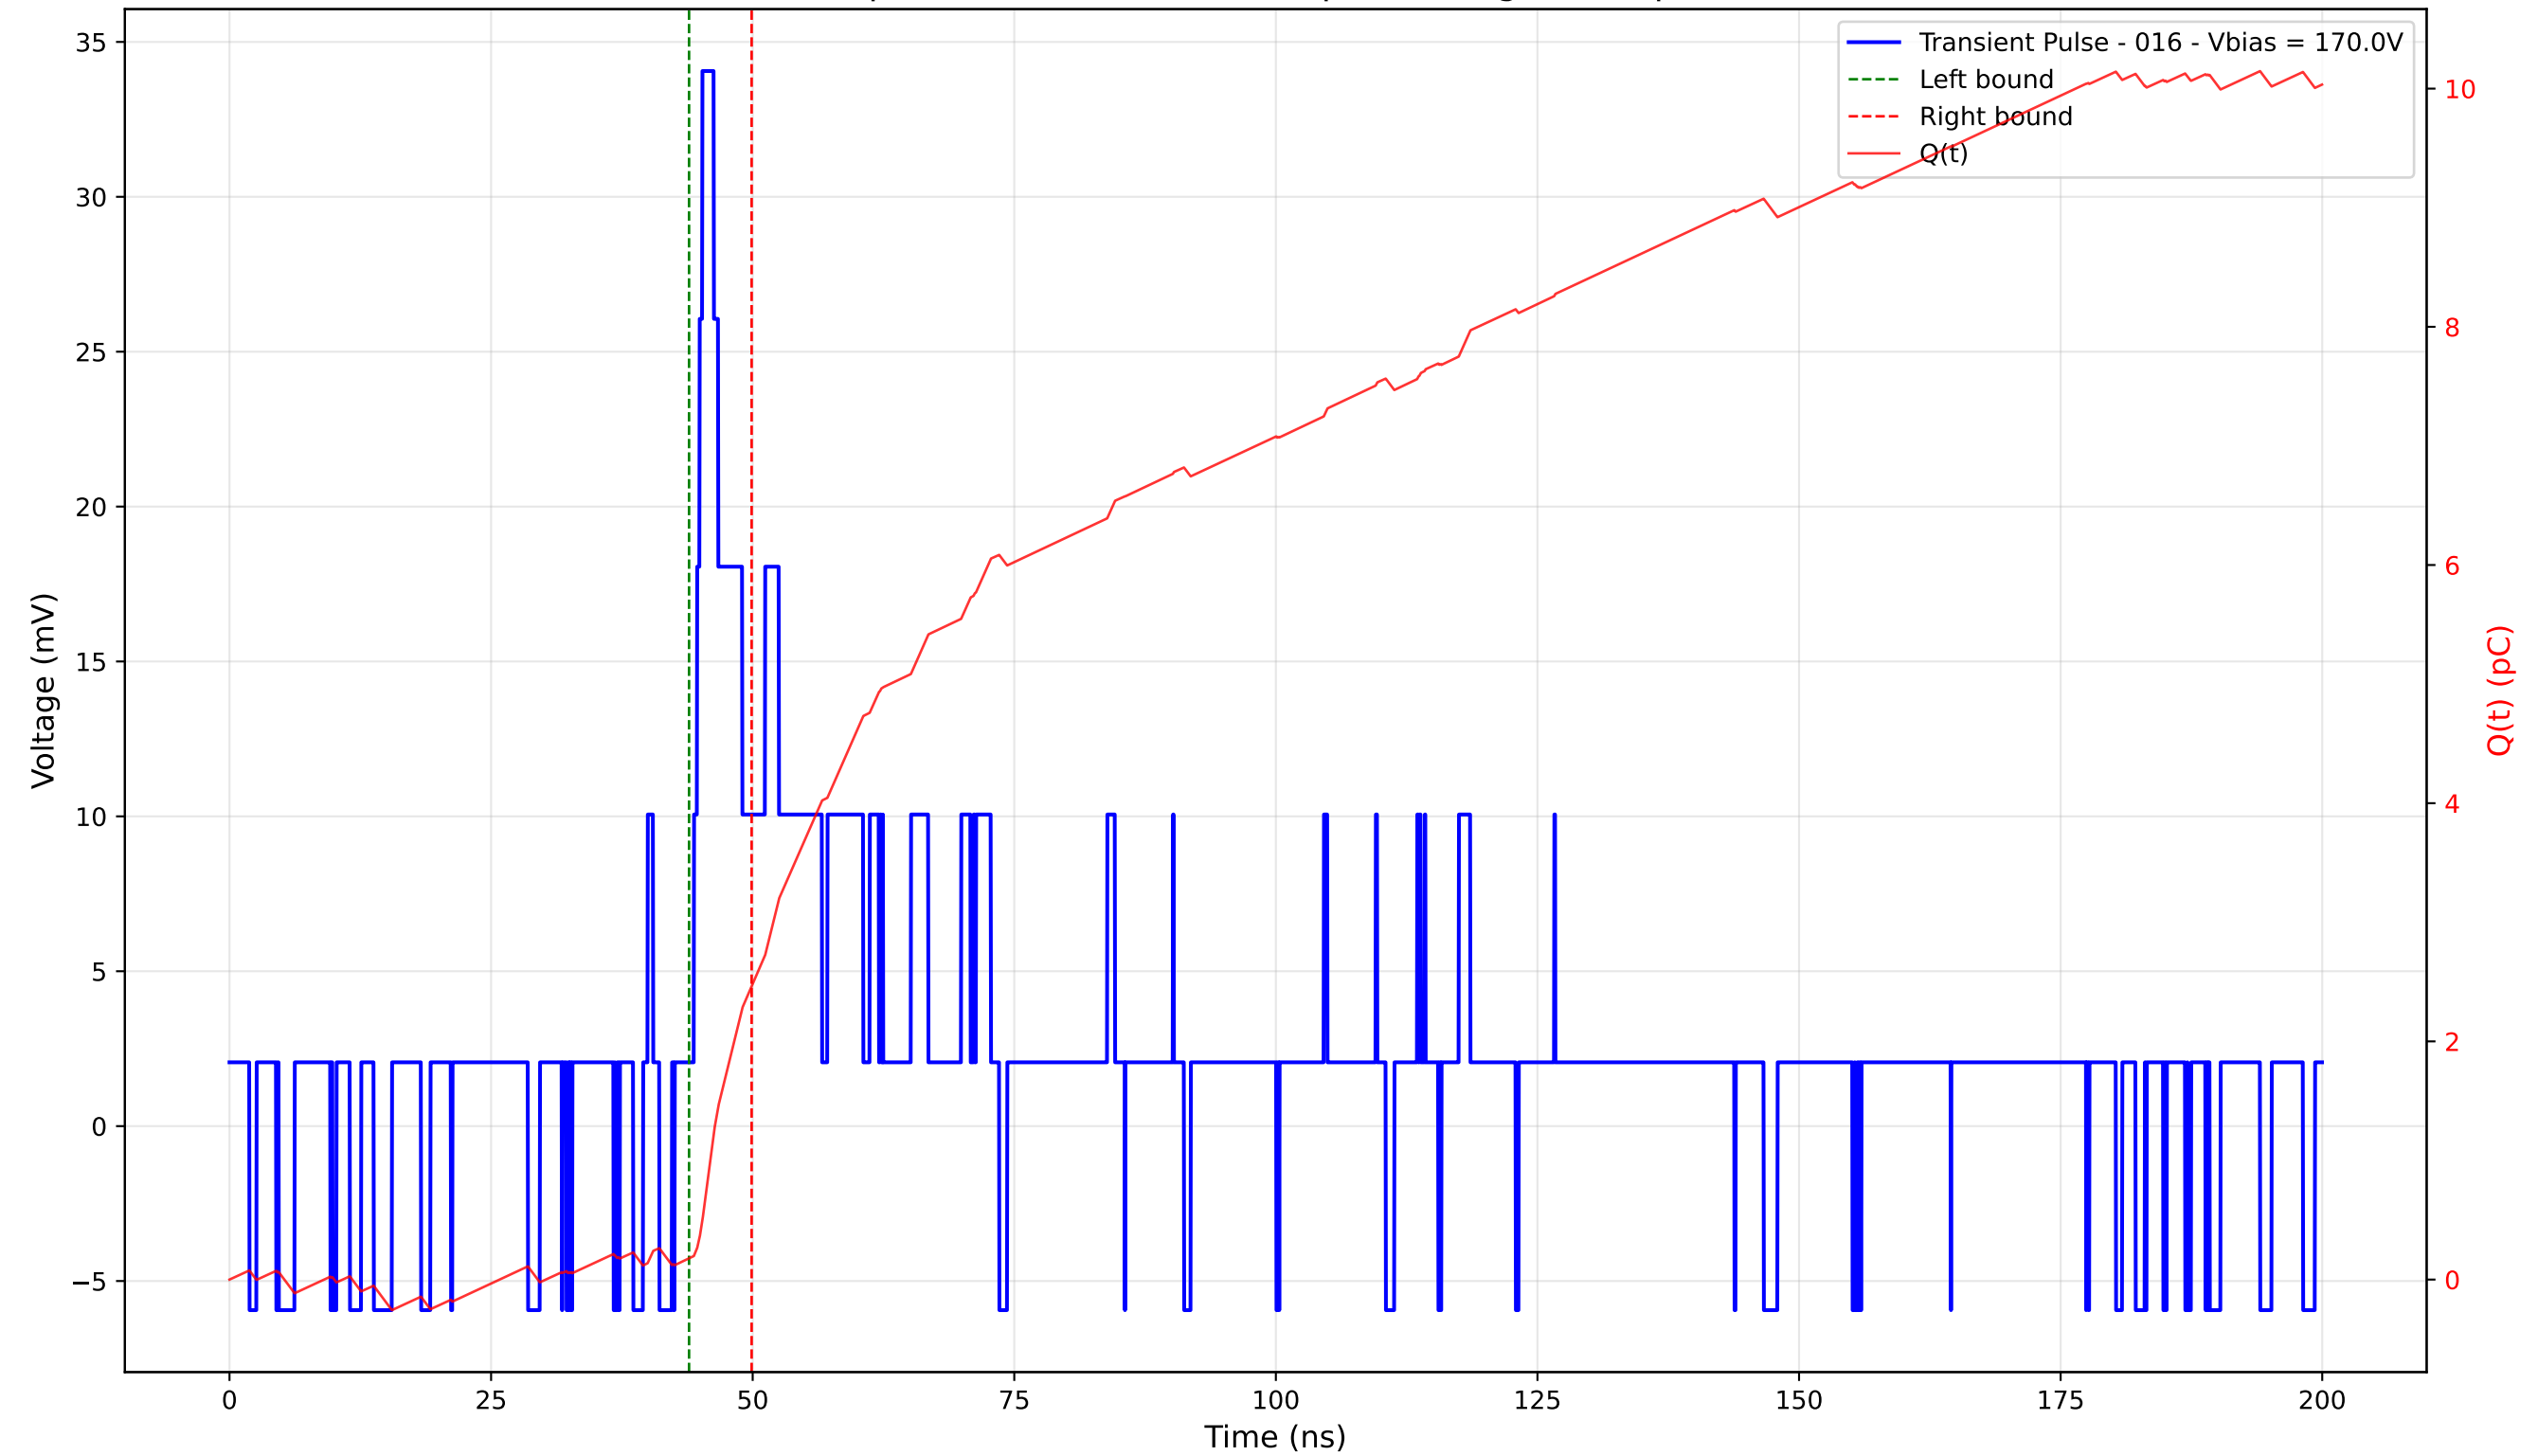


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 4.40 pC - Rise Time: 0.79 ns

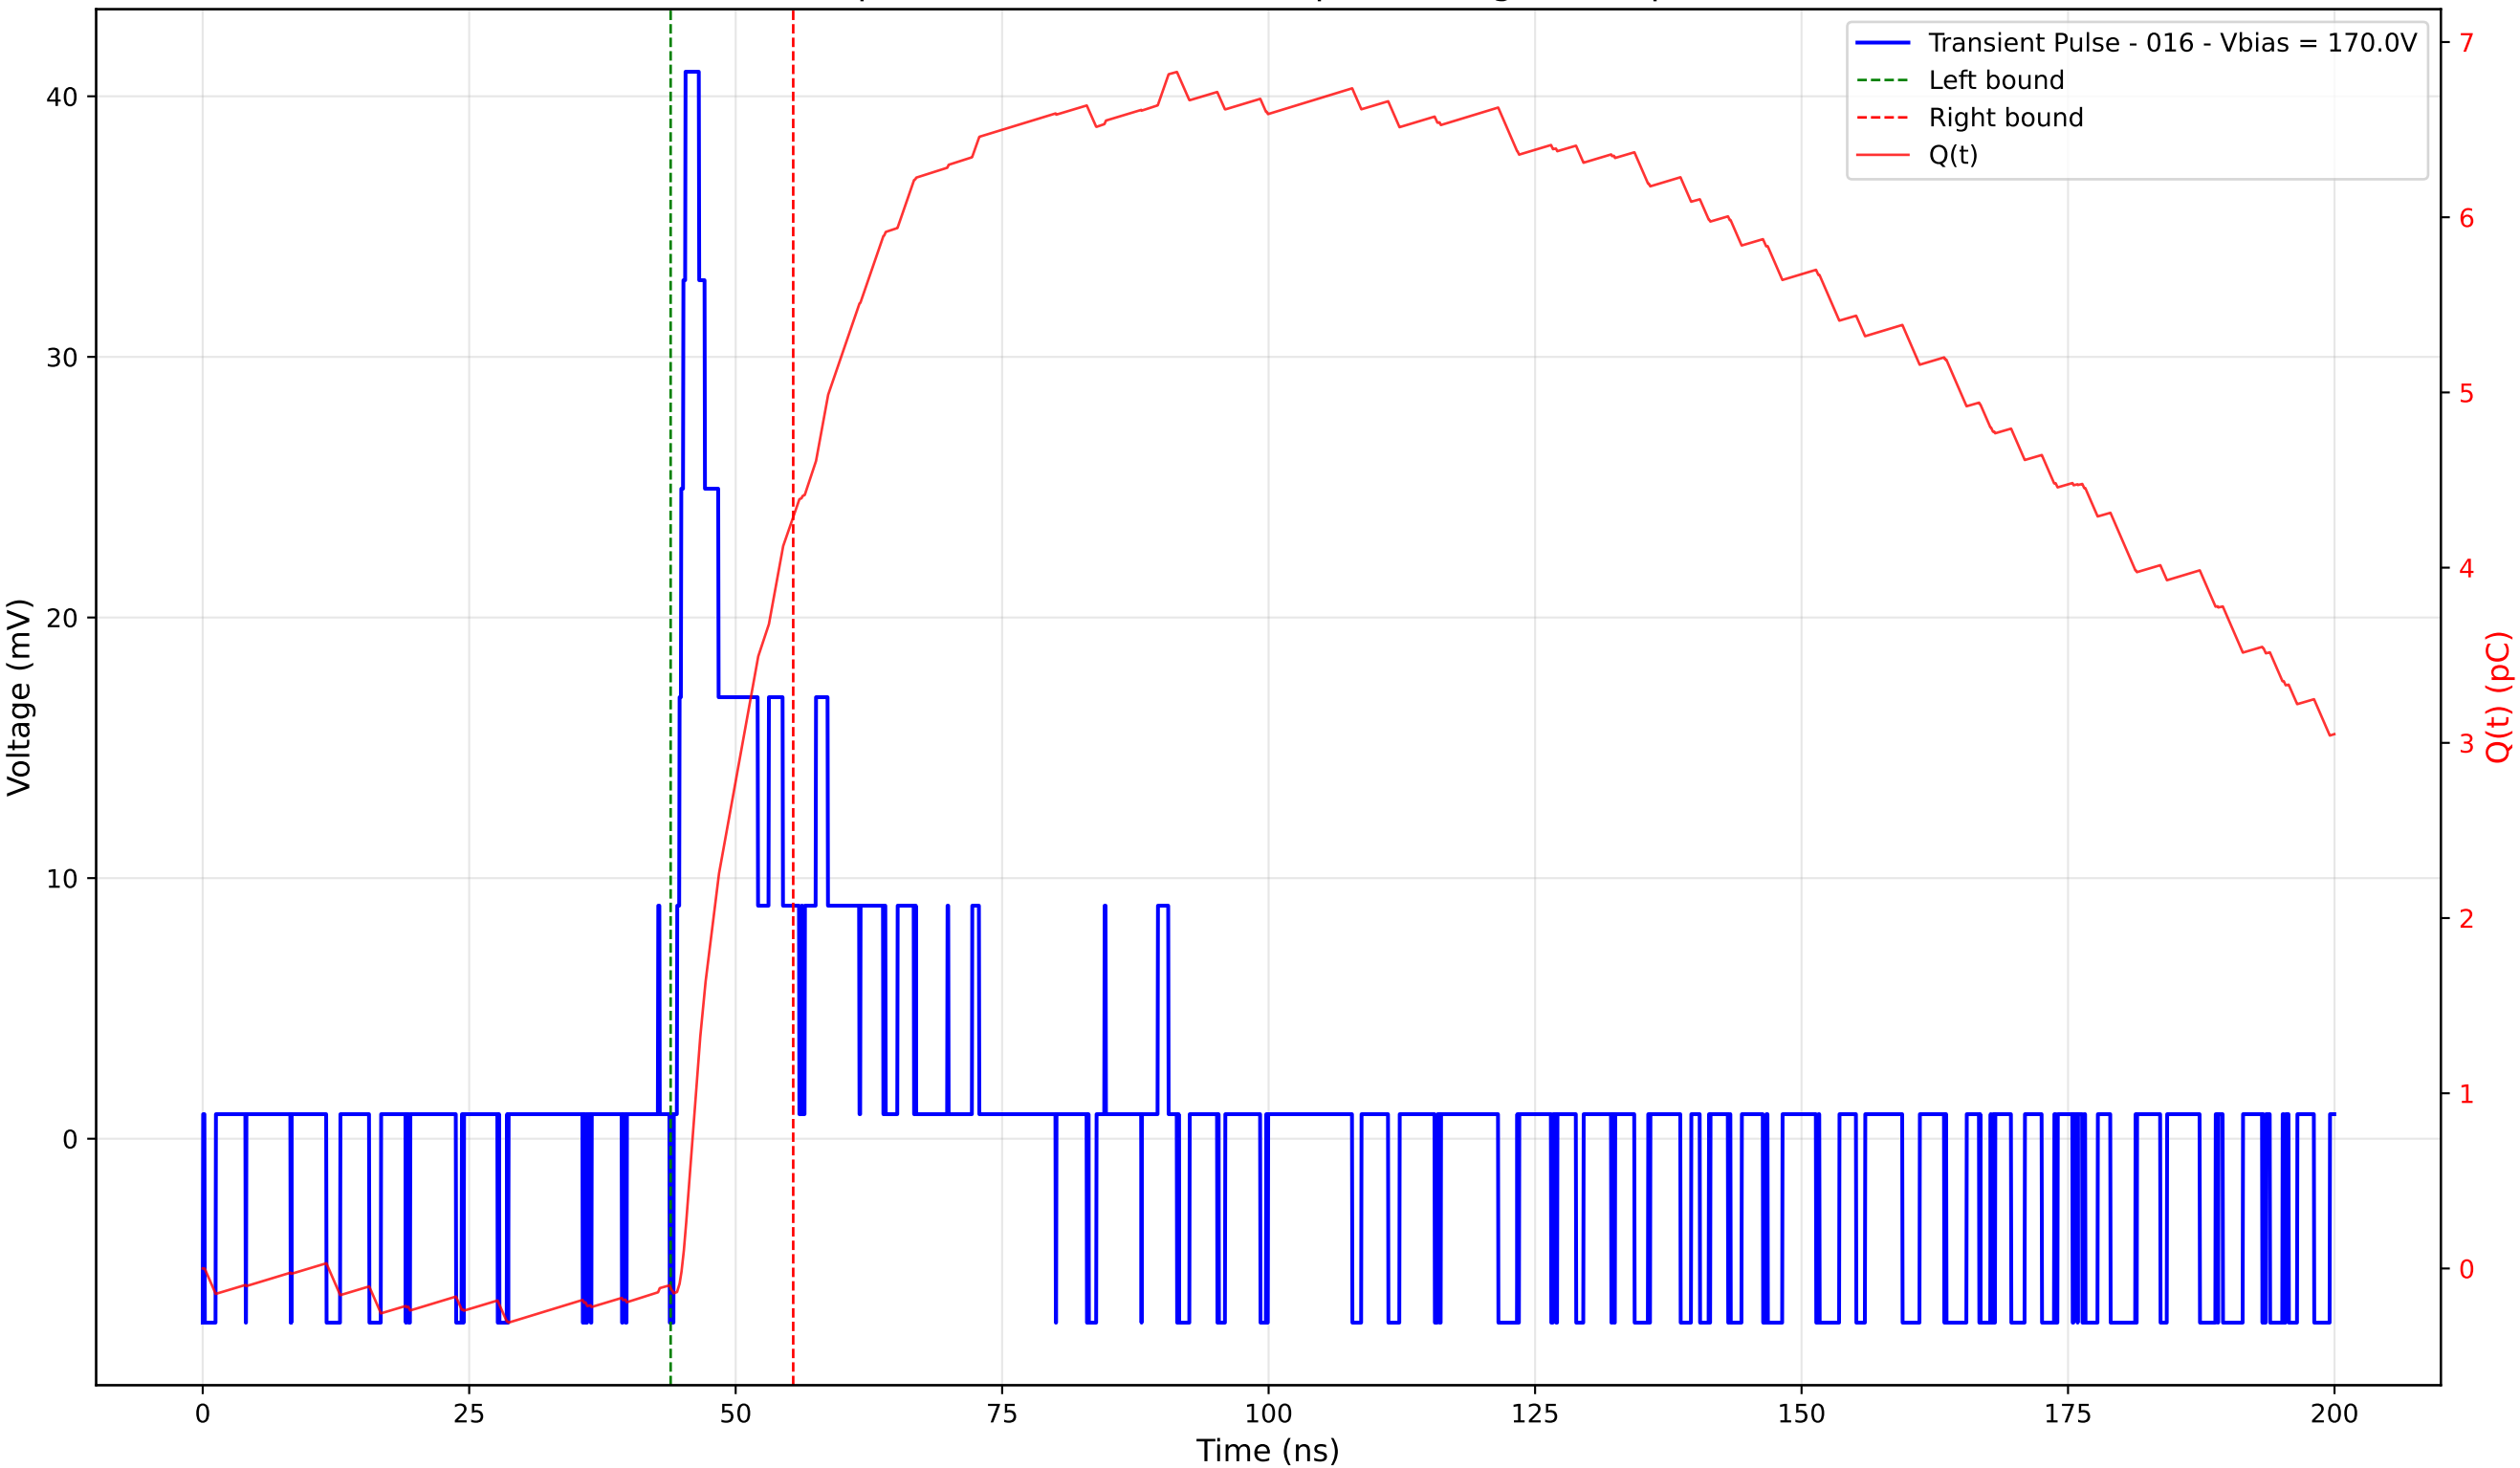


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 6.97 pC - Rise Time: 0.85 ns

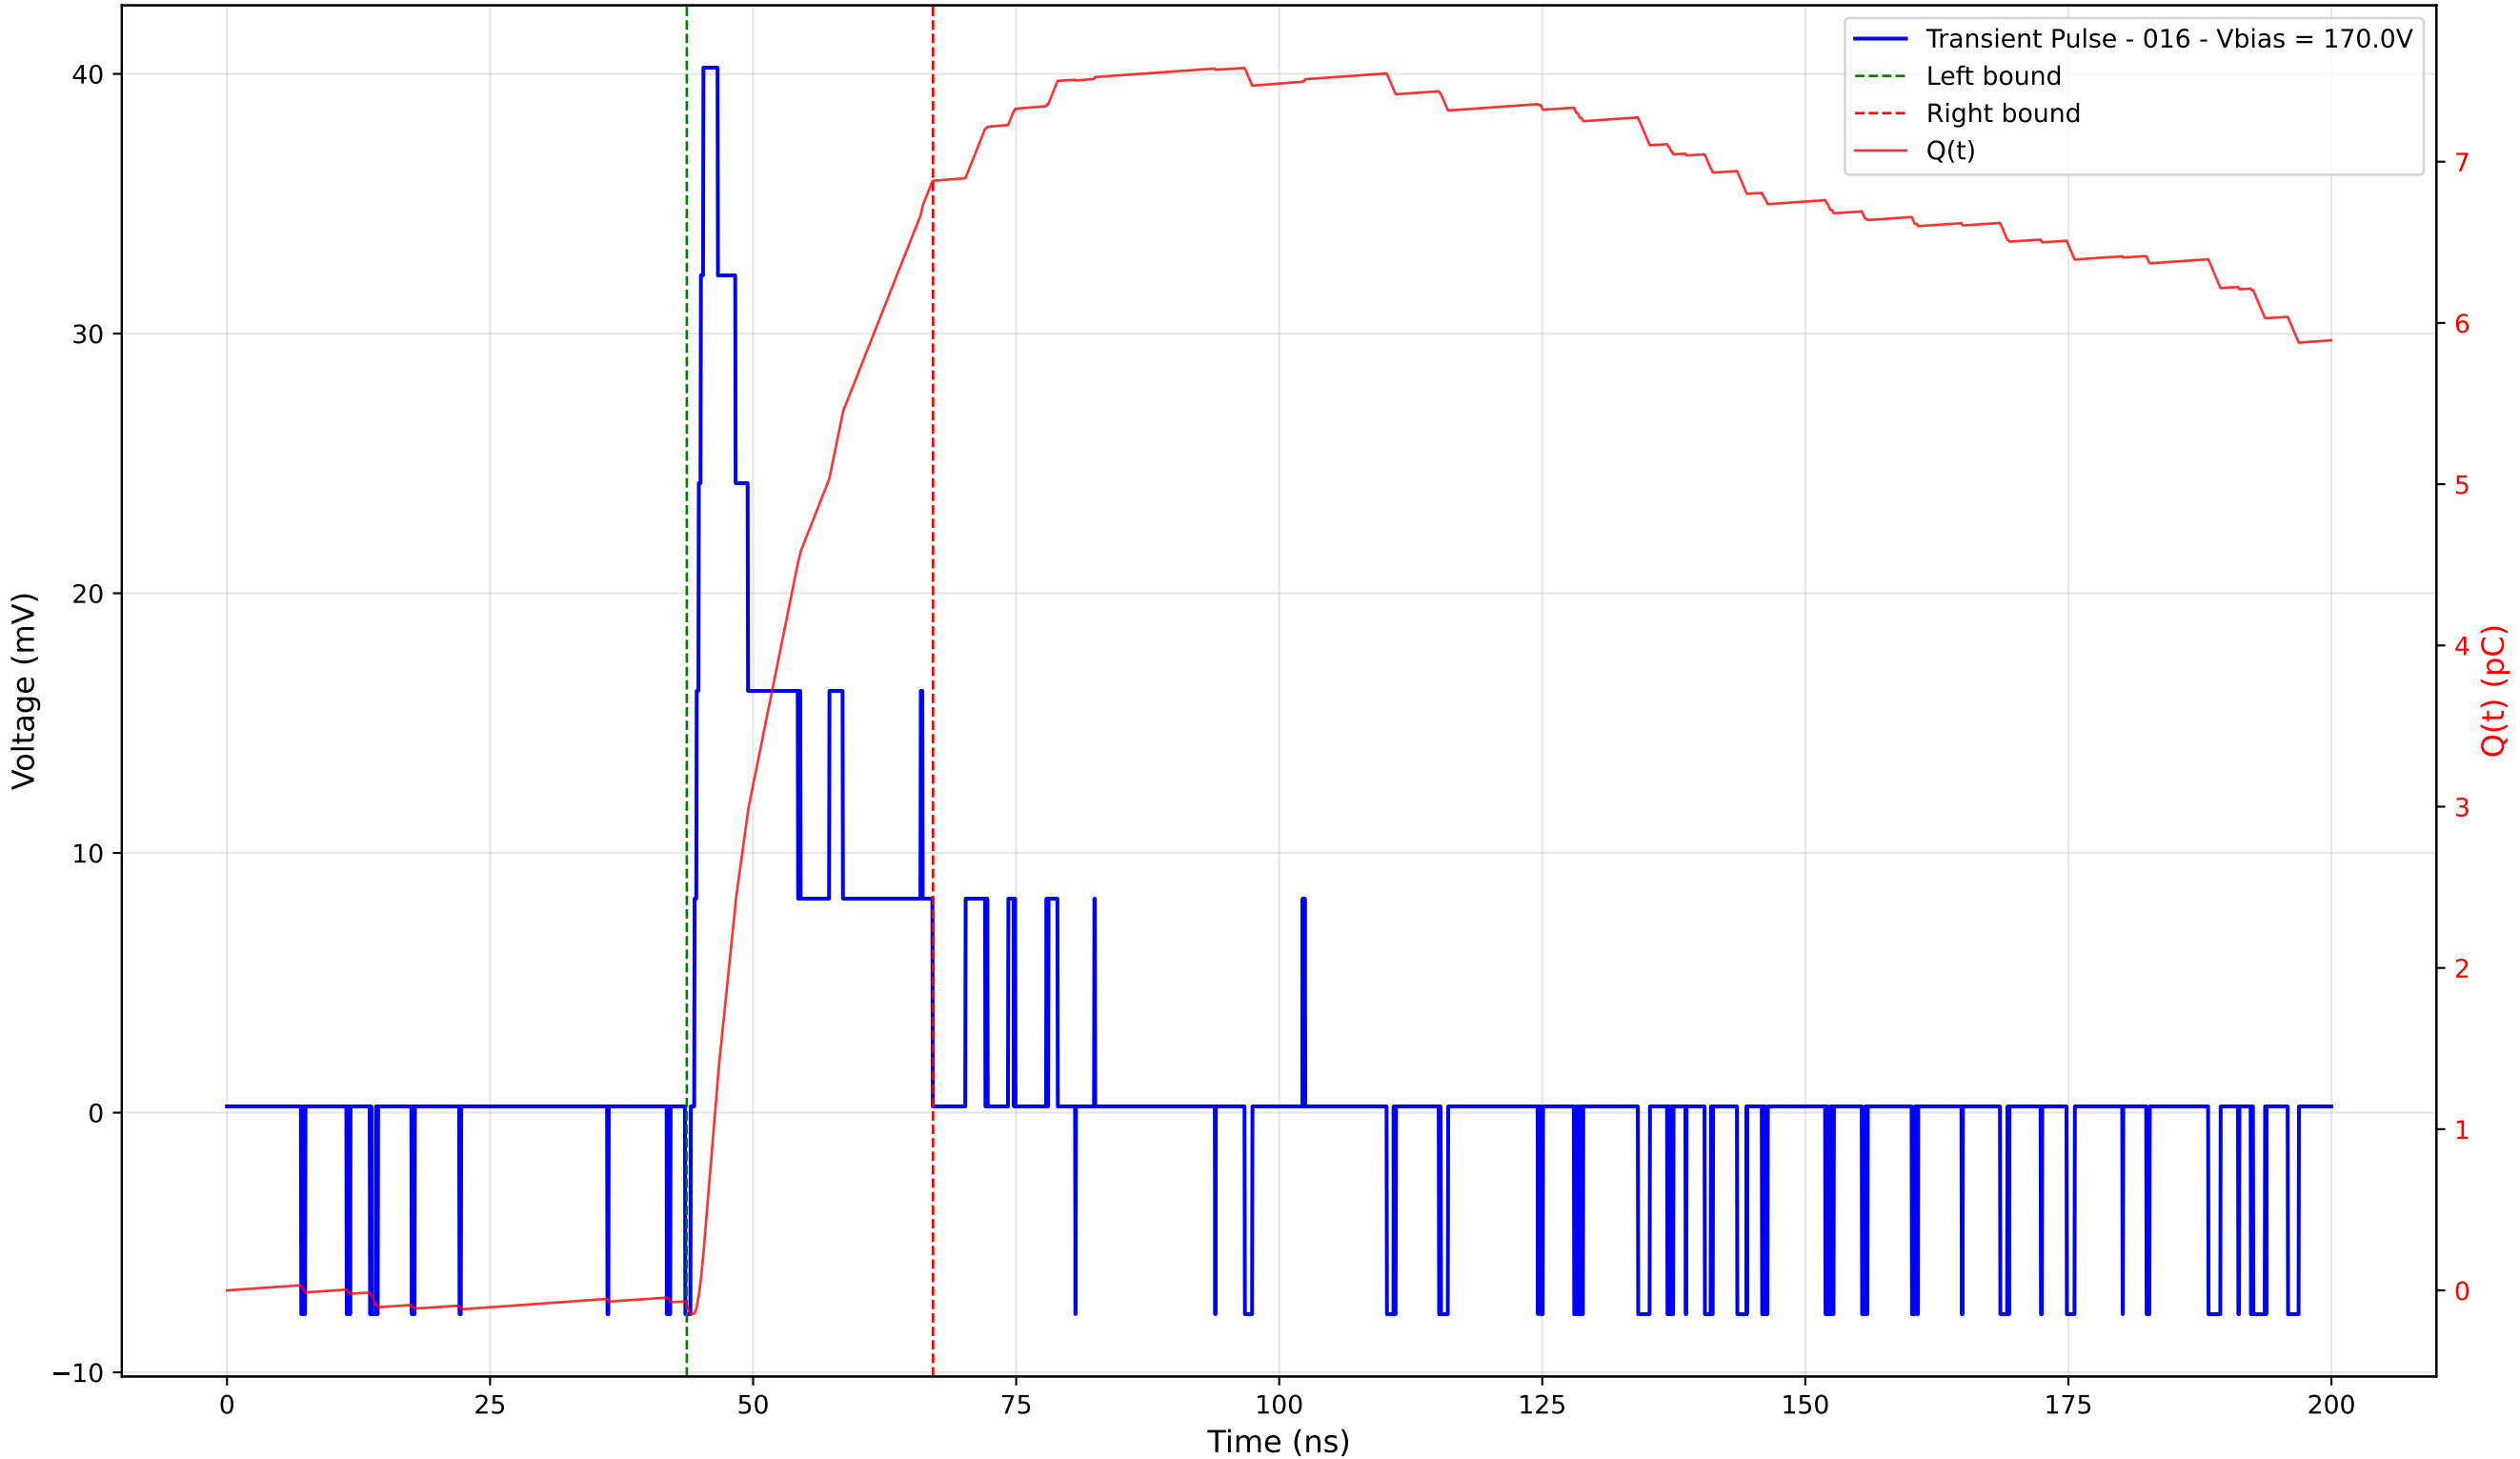


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 5.58 pC - Rise Time: 1.01 ns

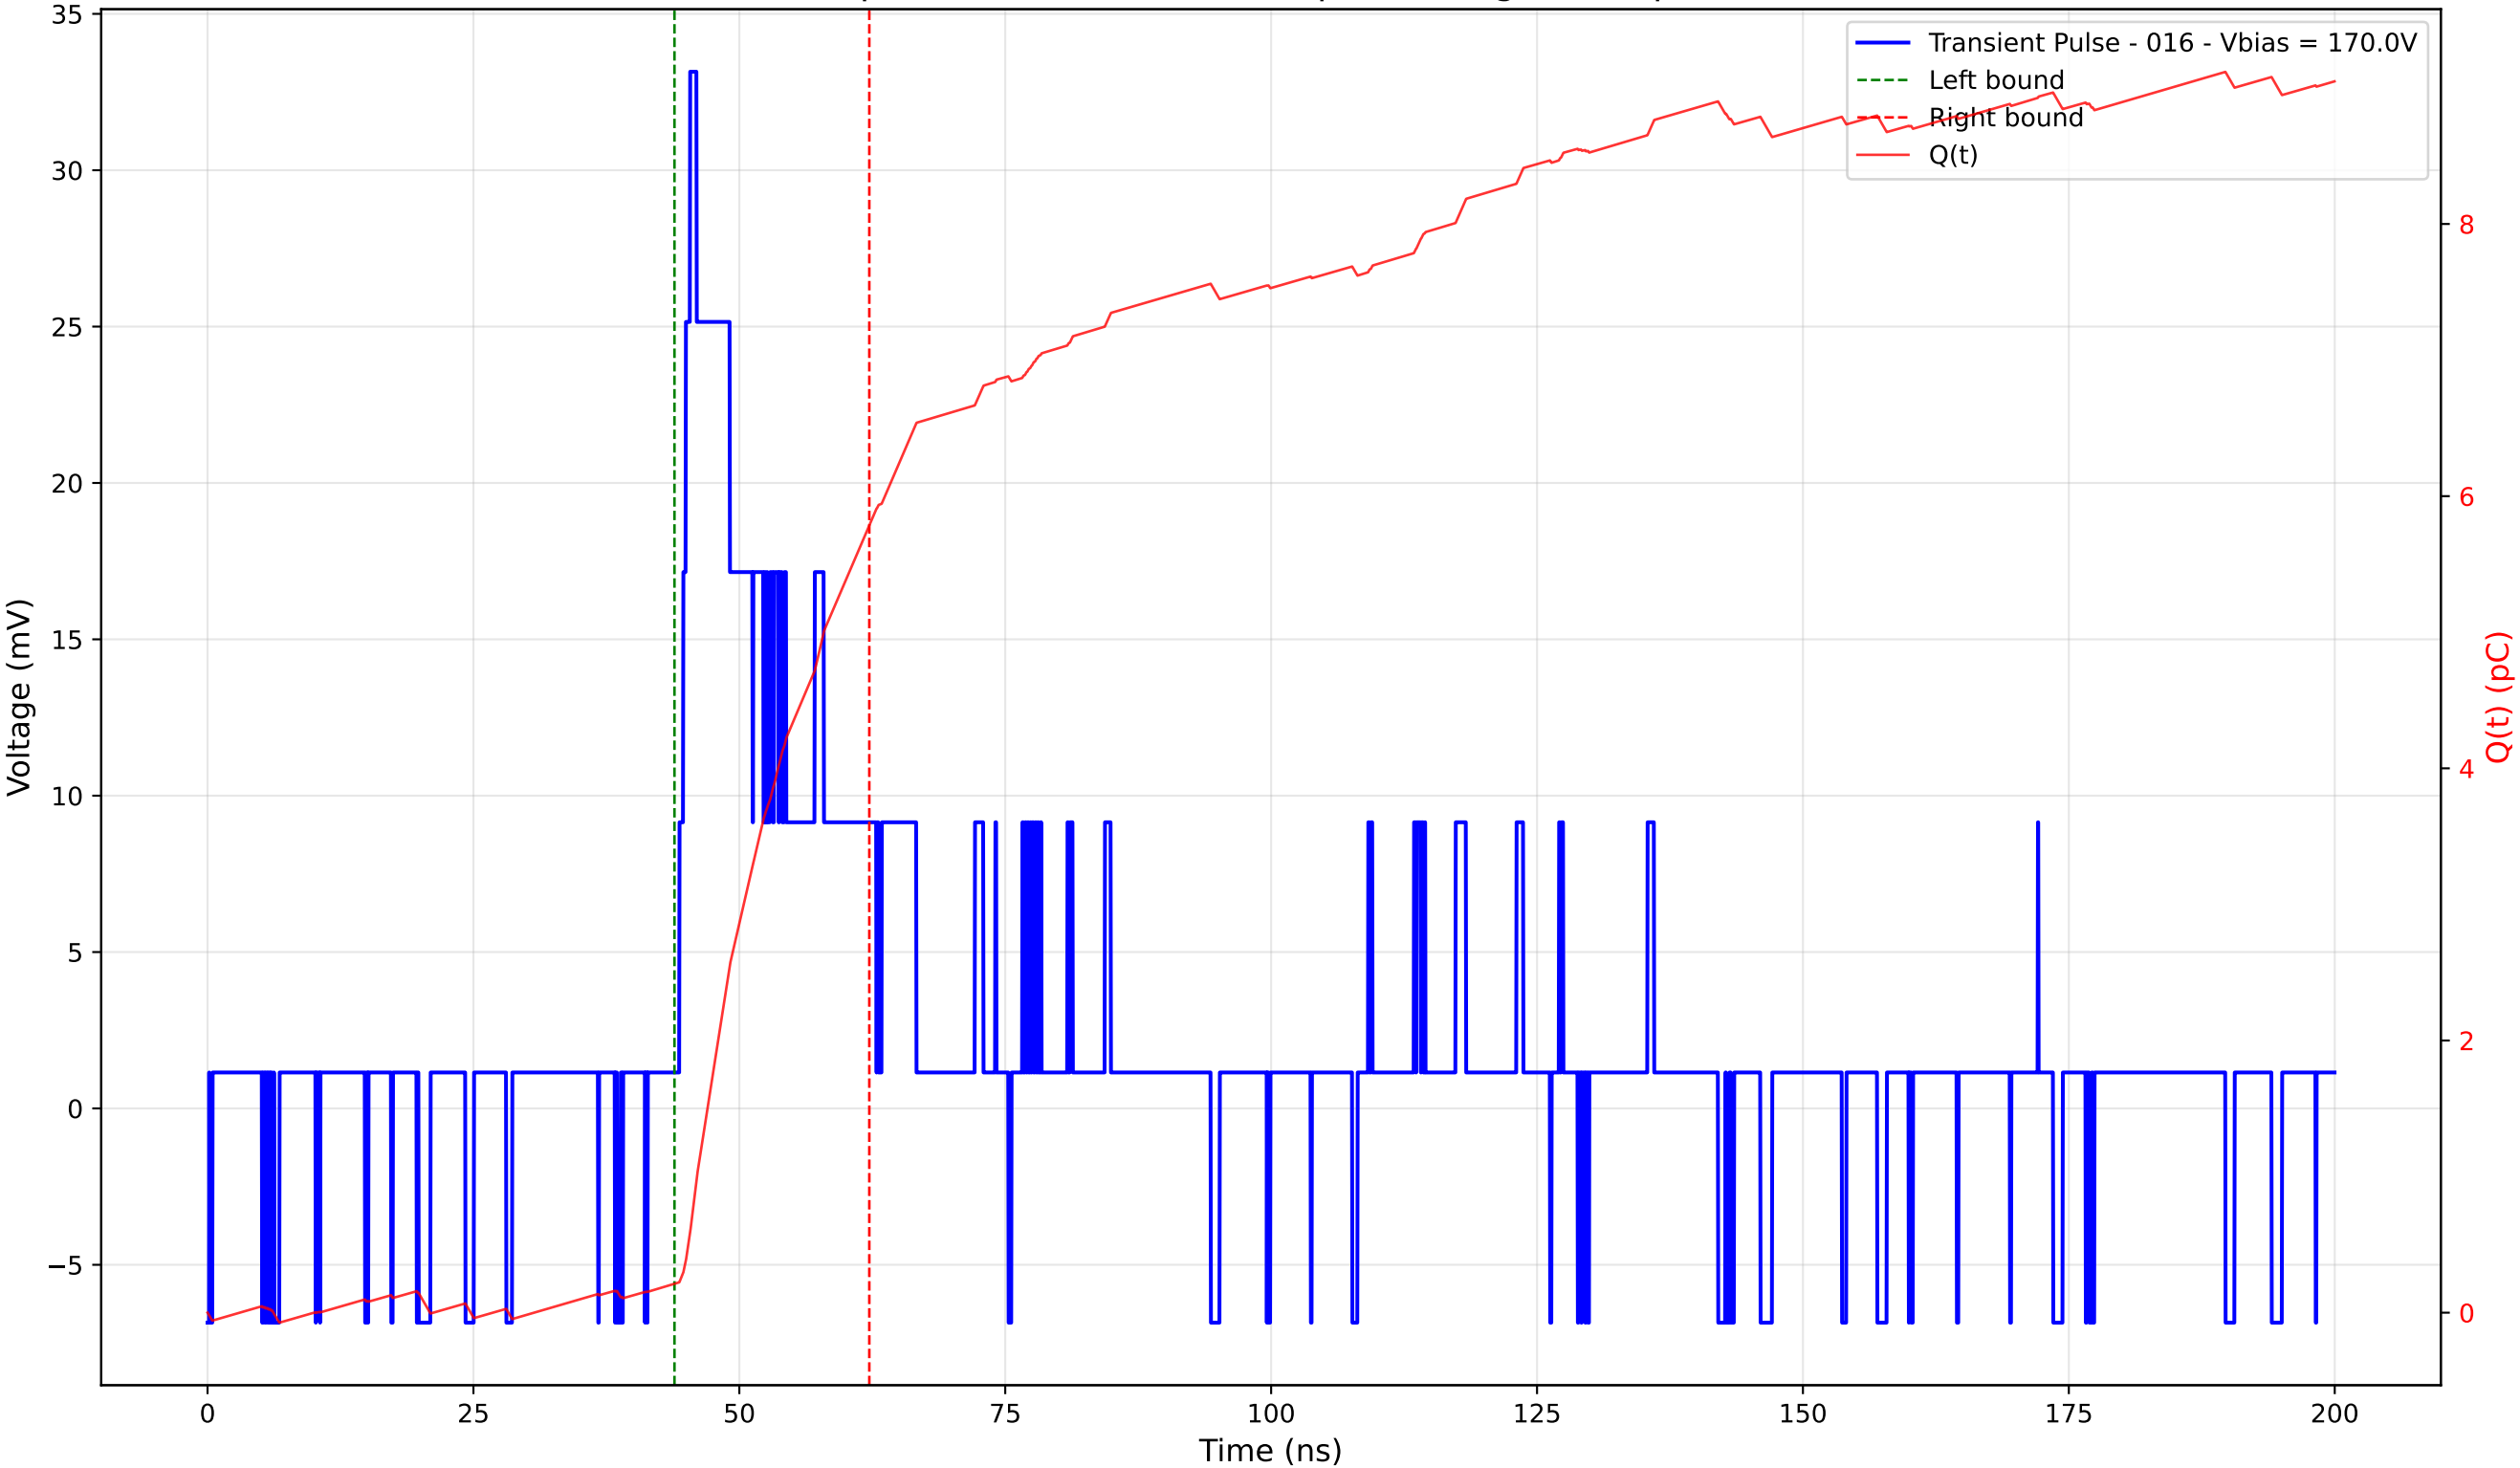


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 4.87 pC - Rise Time: 0.00 ns (N/A)

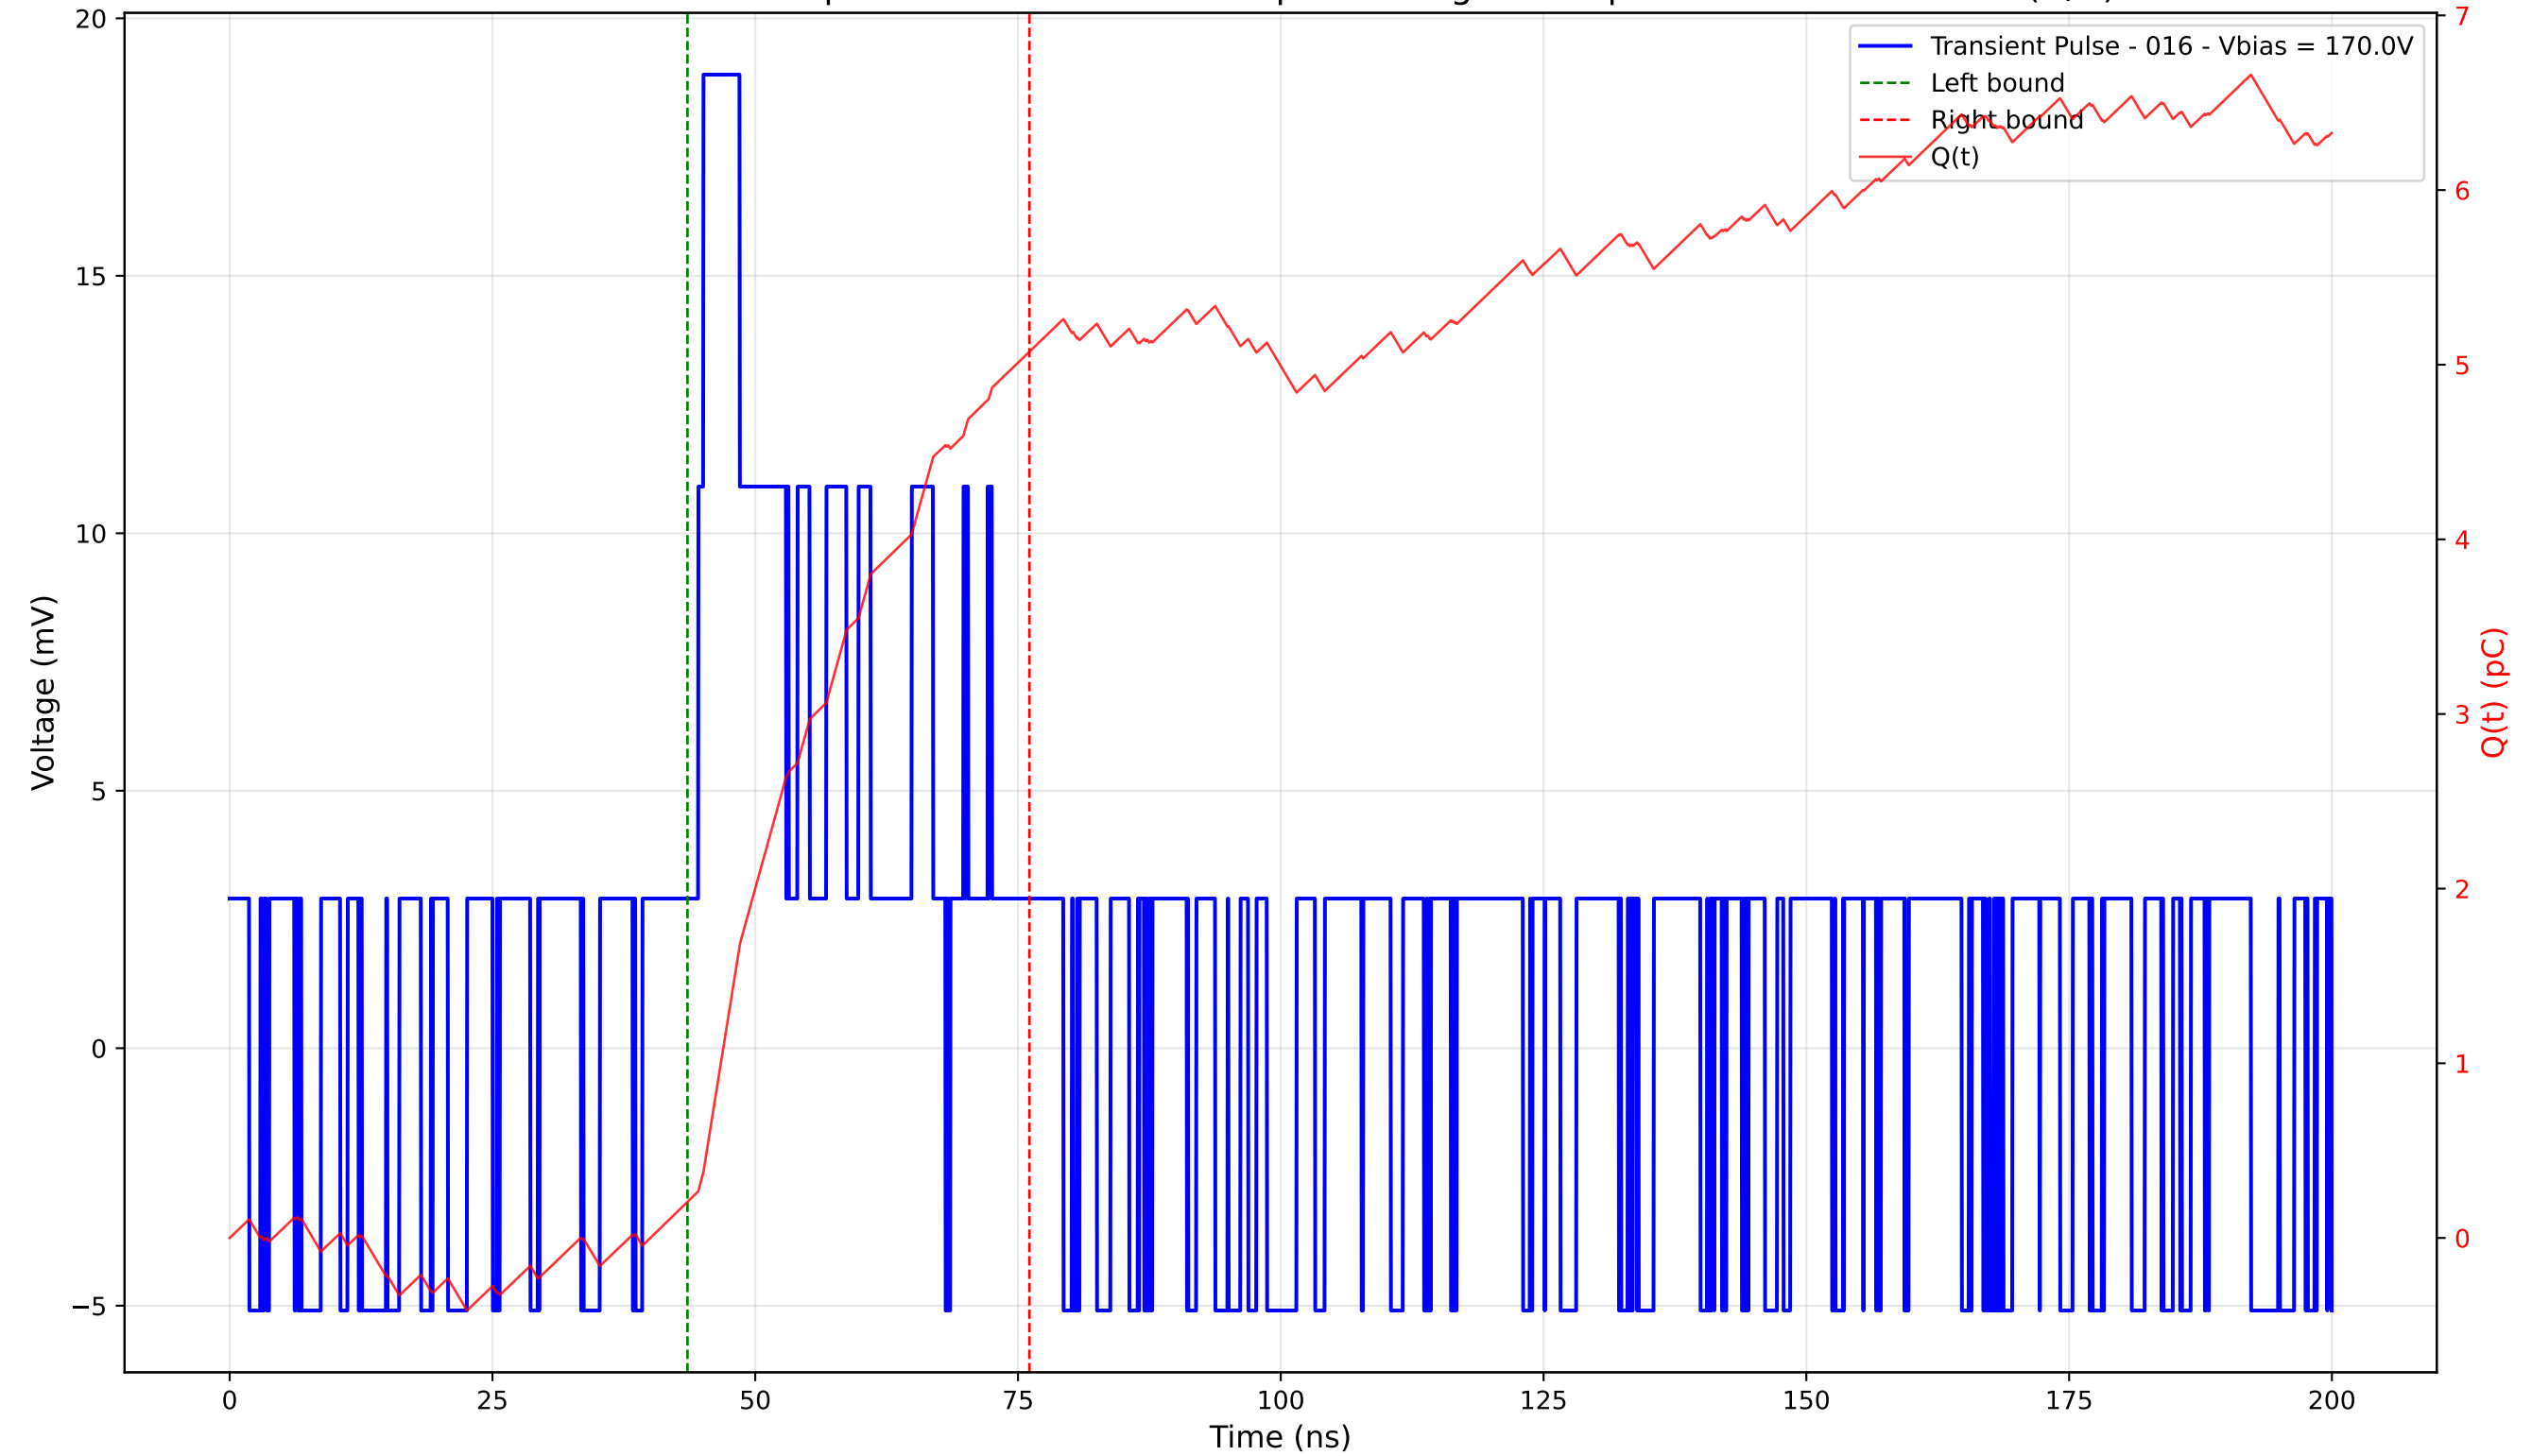


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 1.62 pC - Rise Time: 0.54 ns

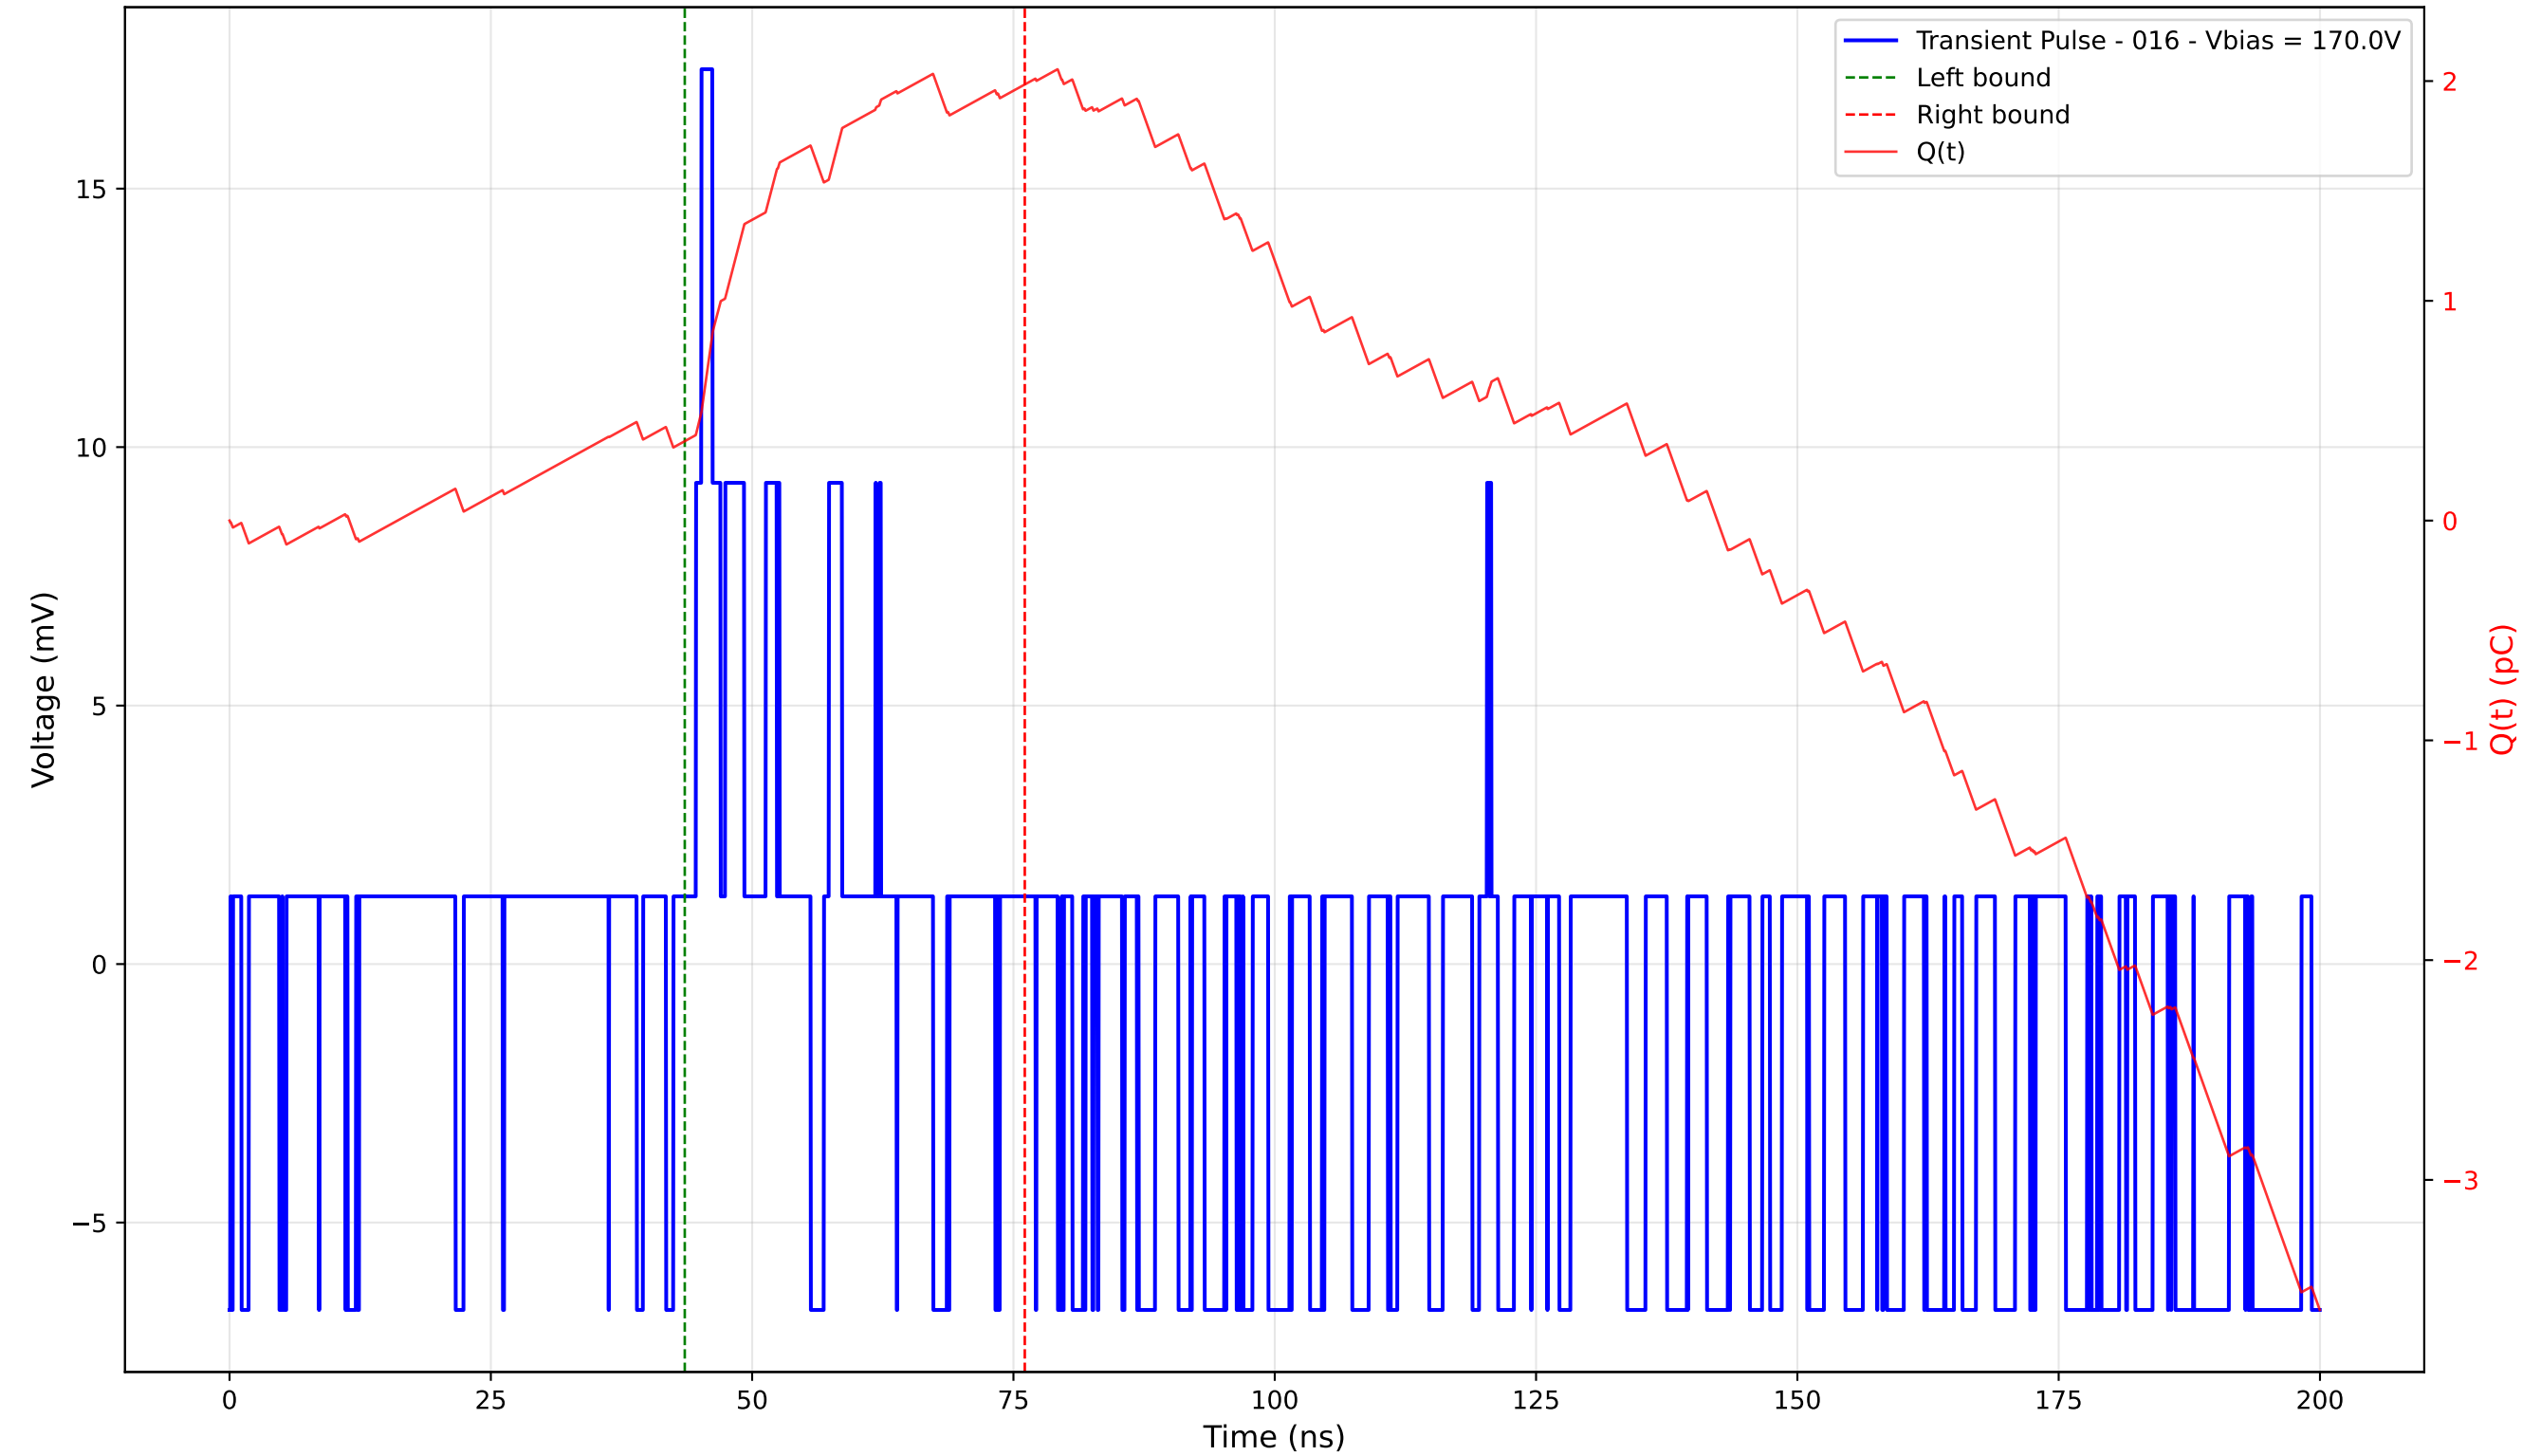


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 0.79 pC - Rise Time: 0.66 ns

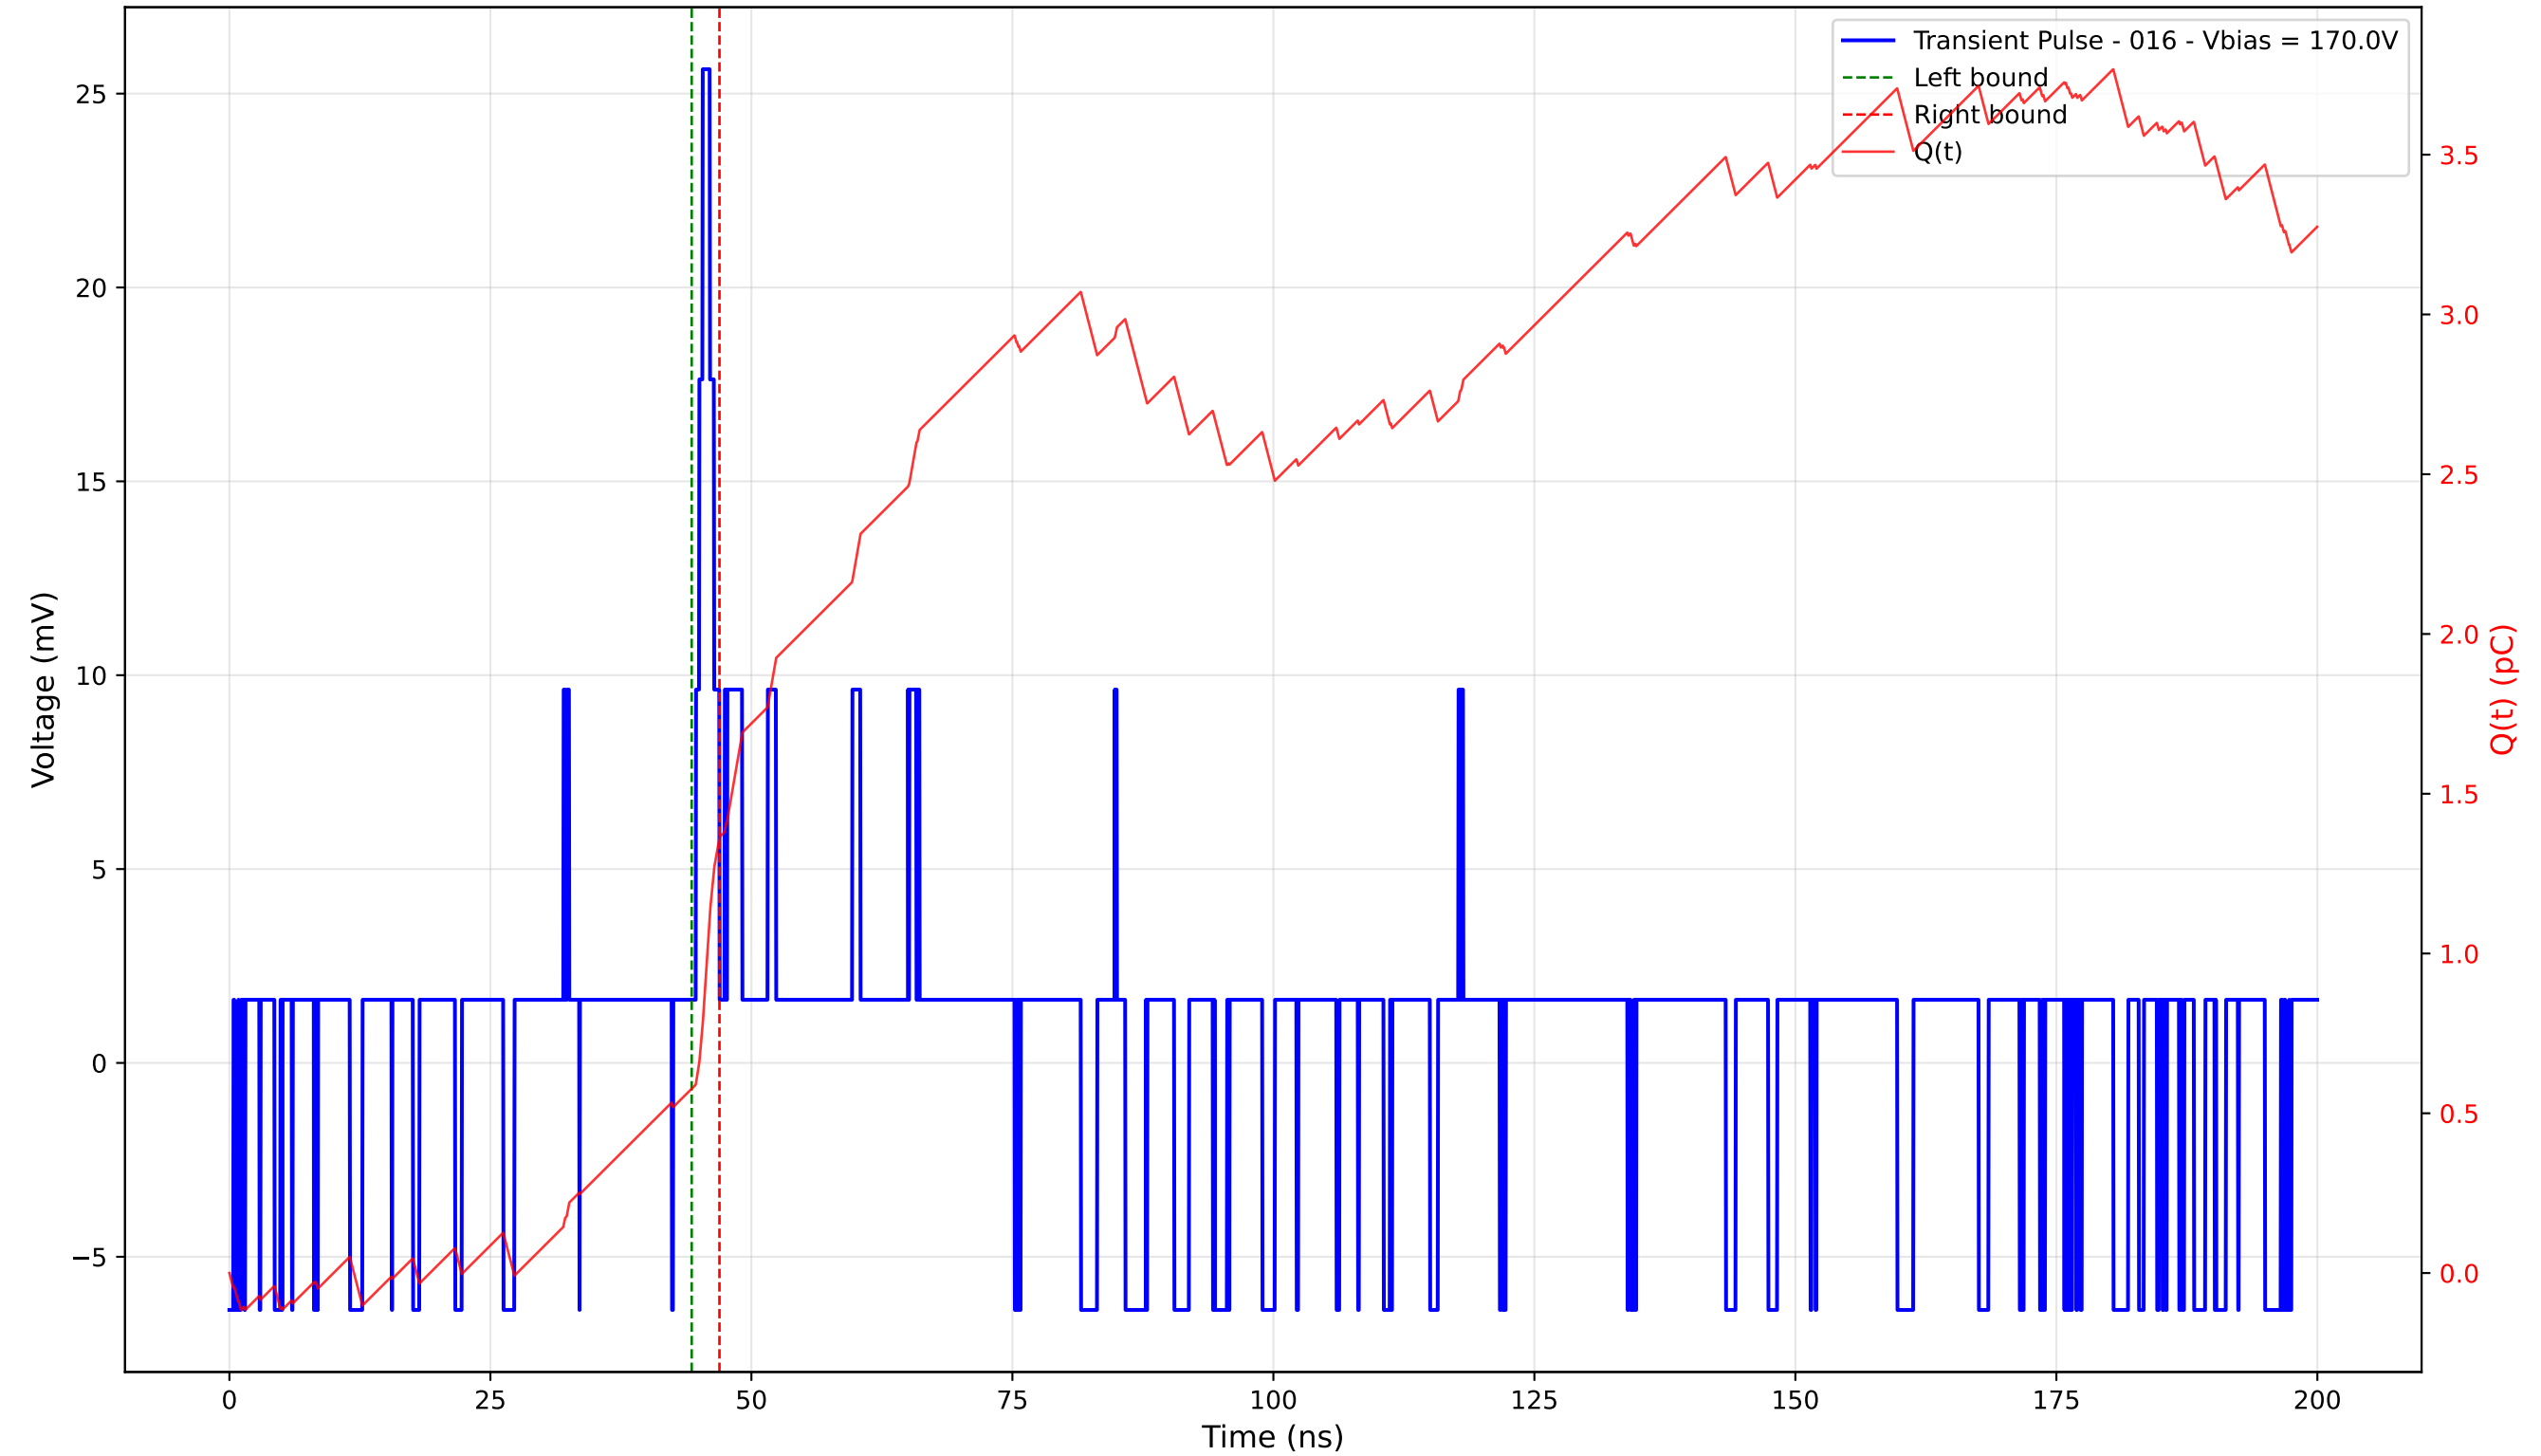


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 1.96 pC - Rise Time: 0.81 ns

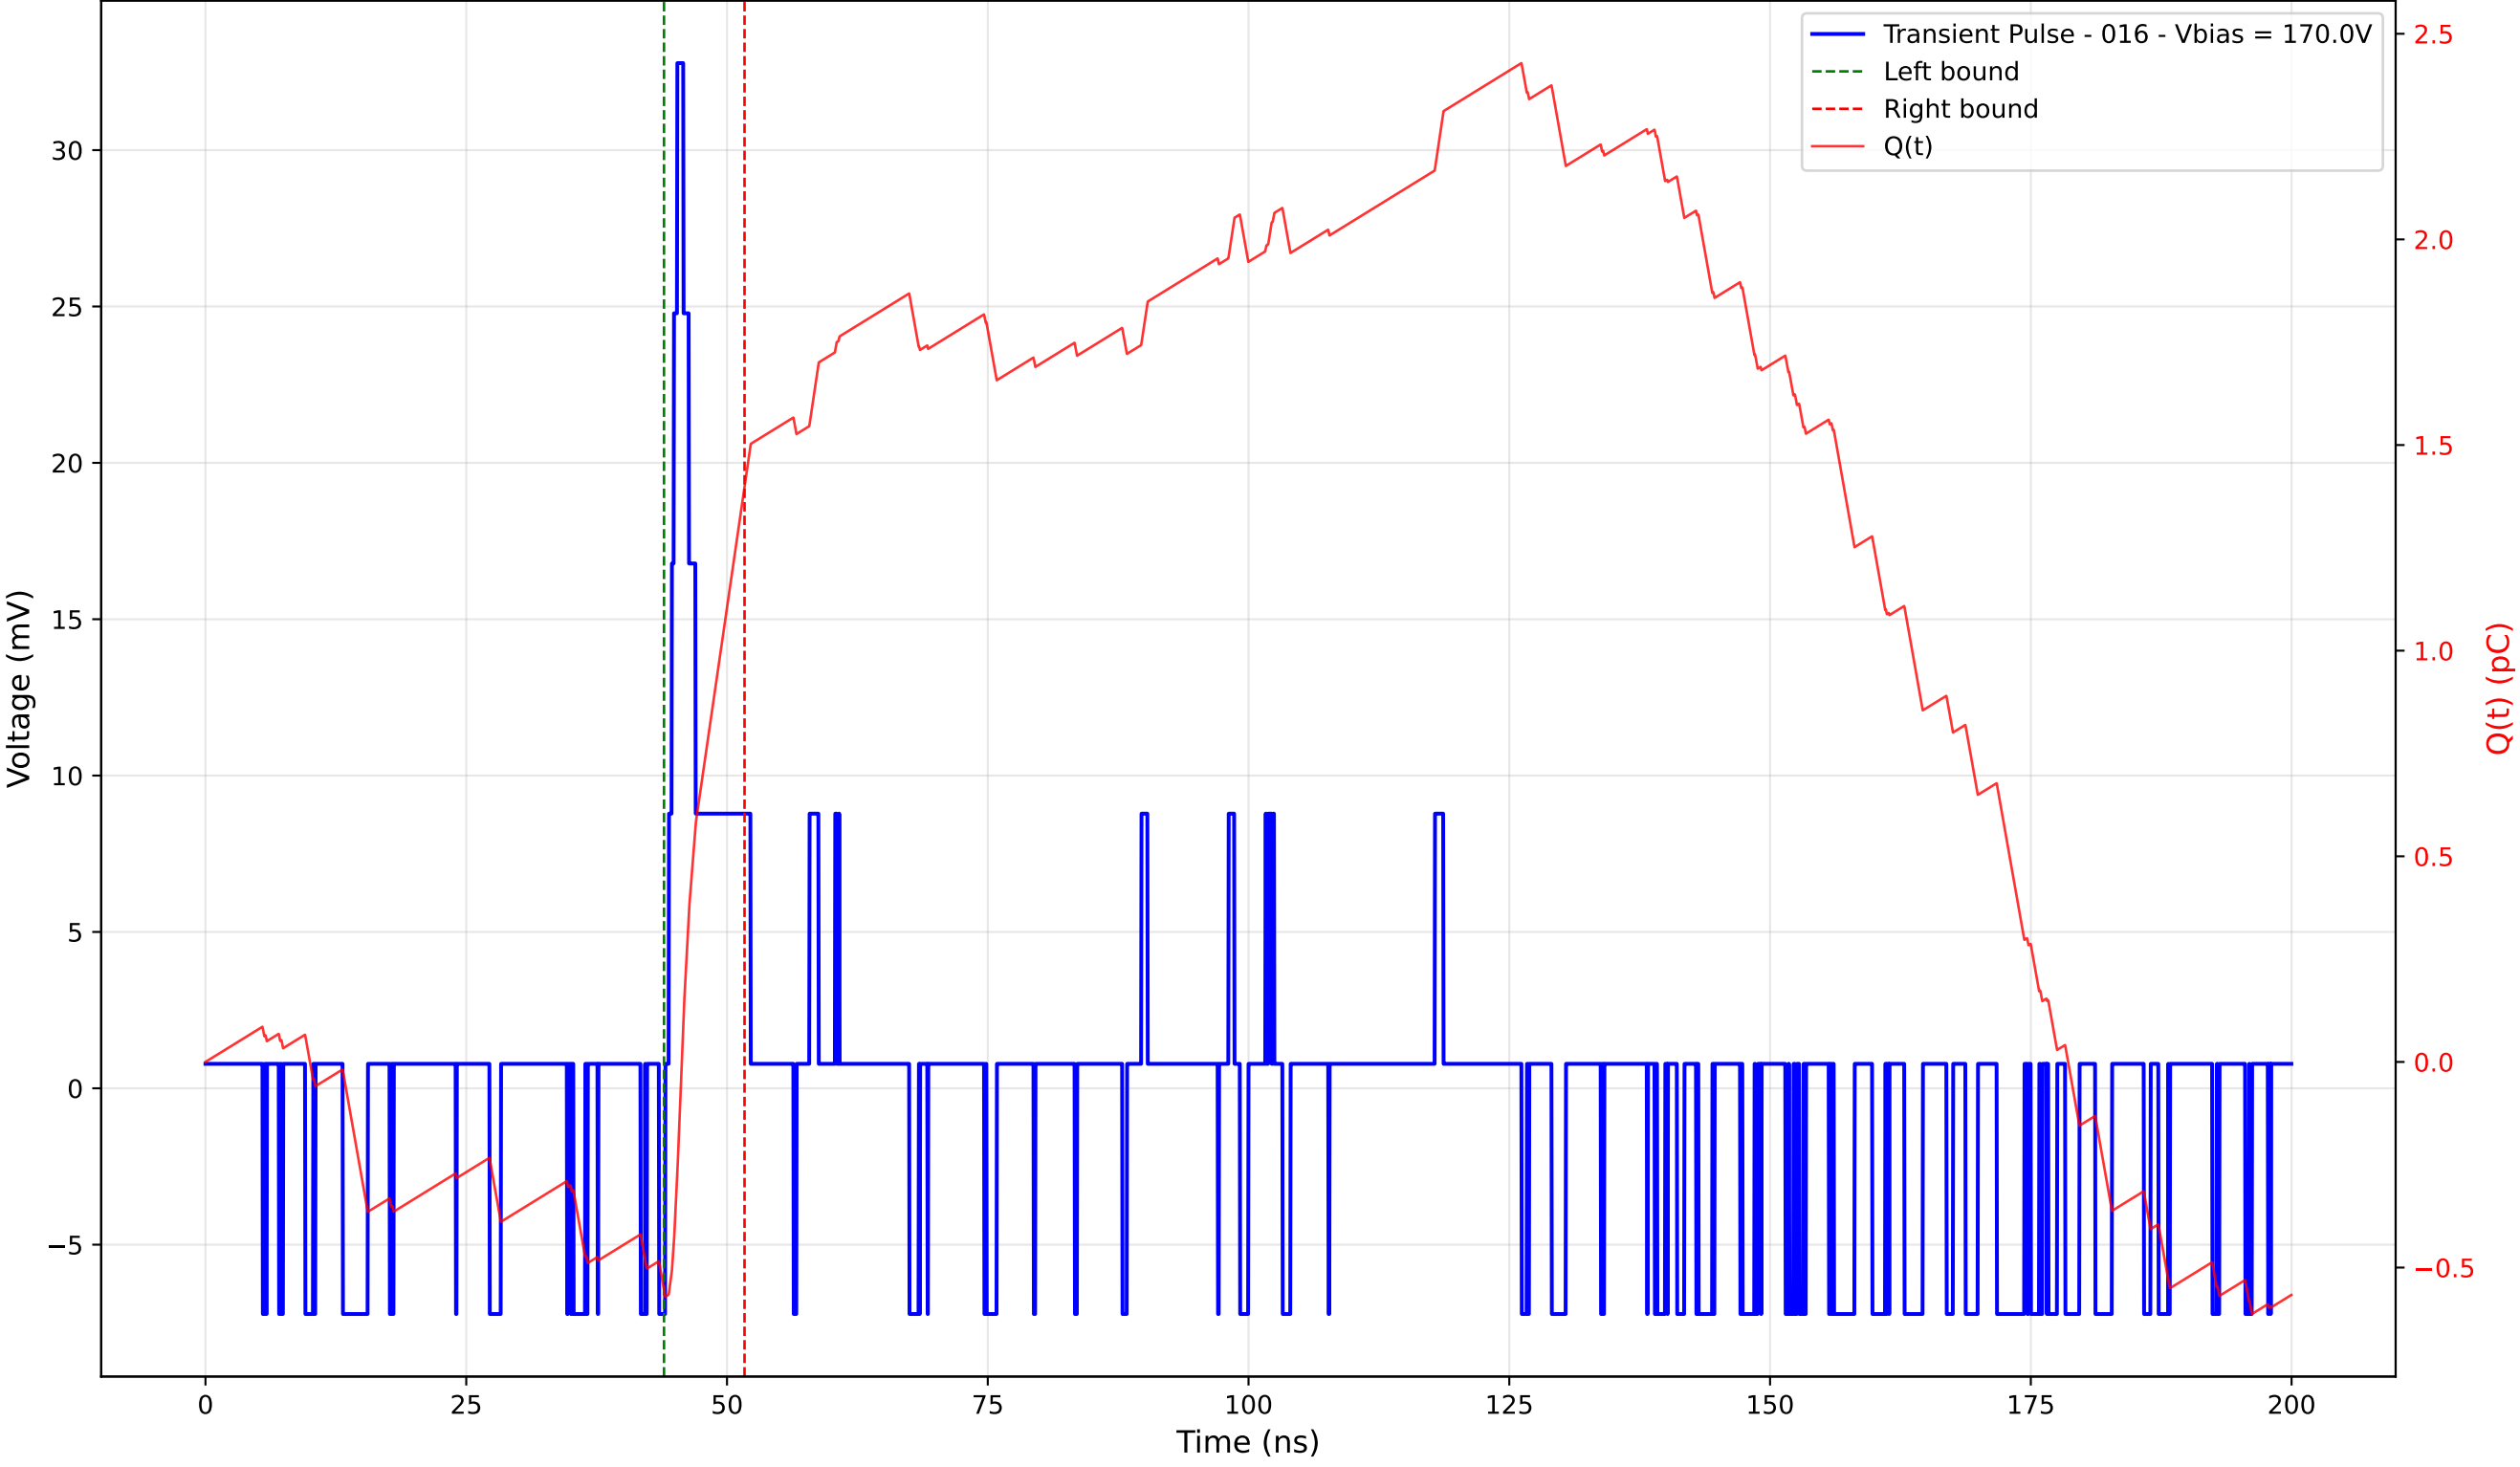


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 3.28 pC - Rise Time: 0.91 ns

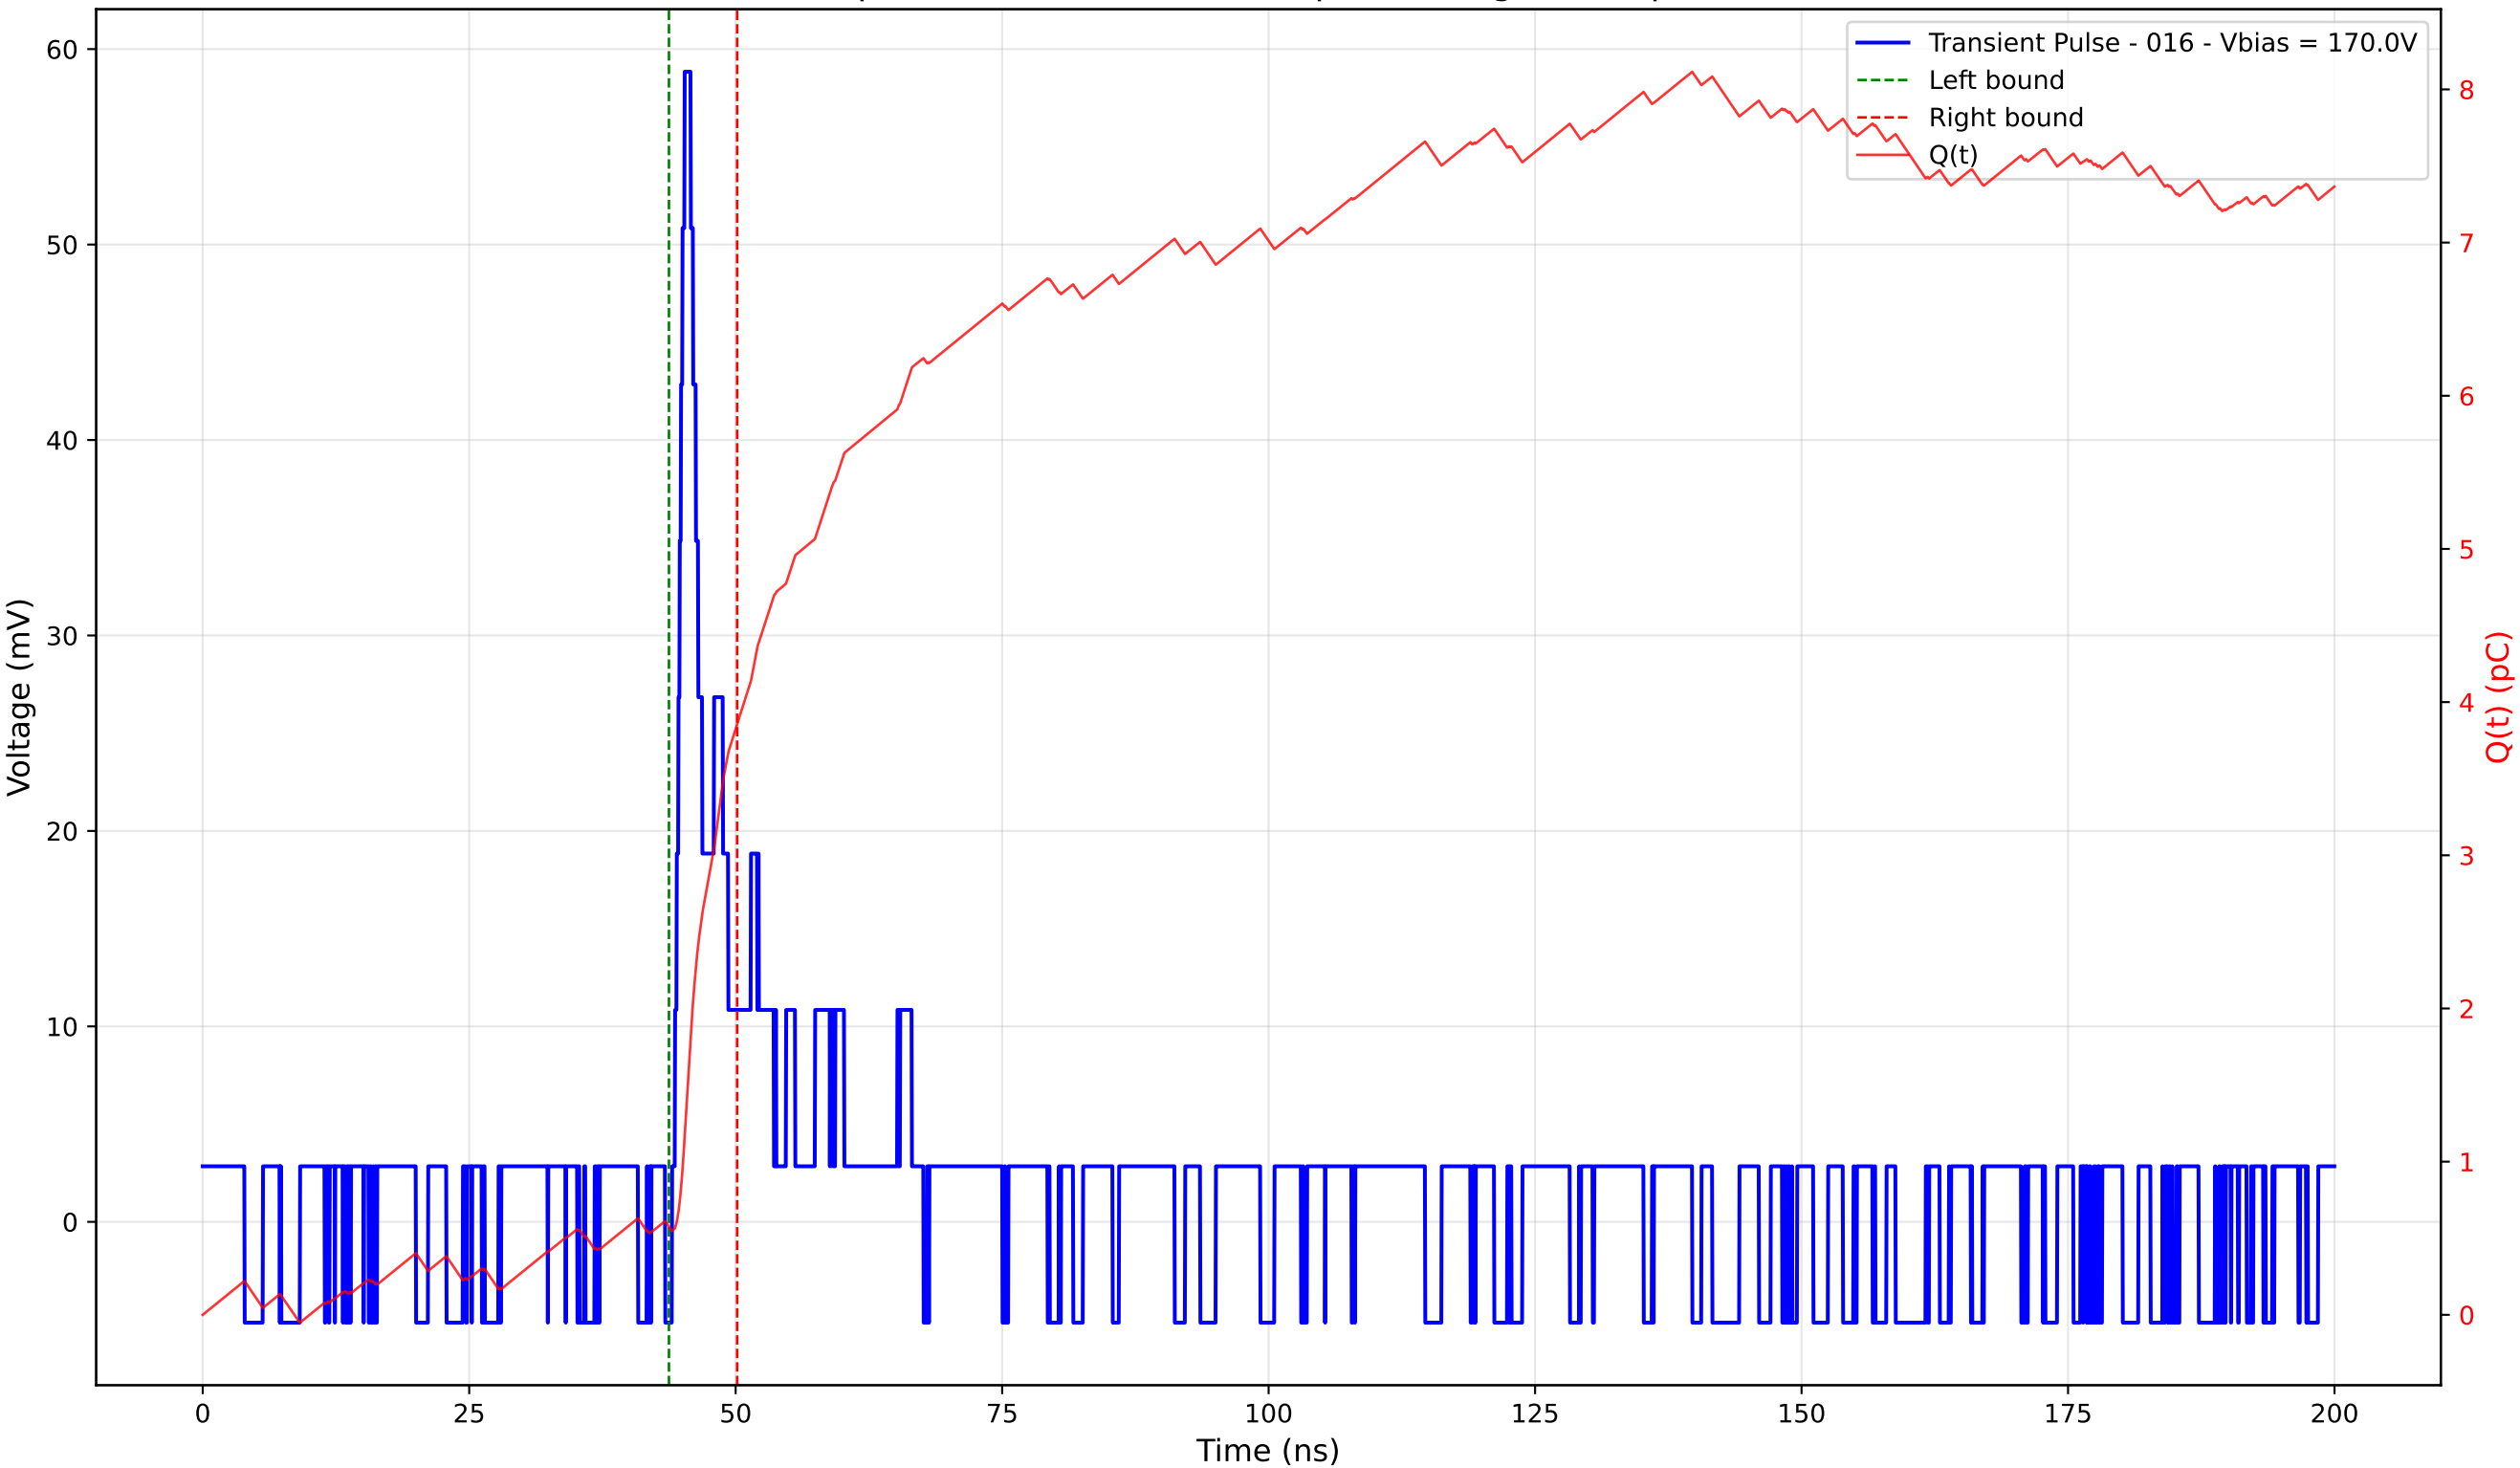


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 8.50 pC - Rise Time: 0.86 ns

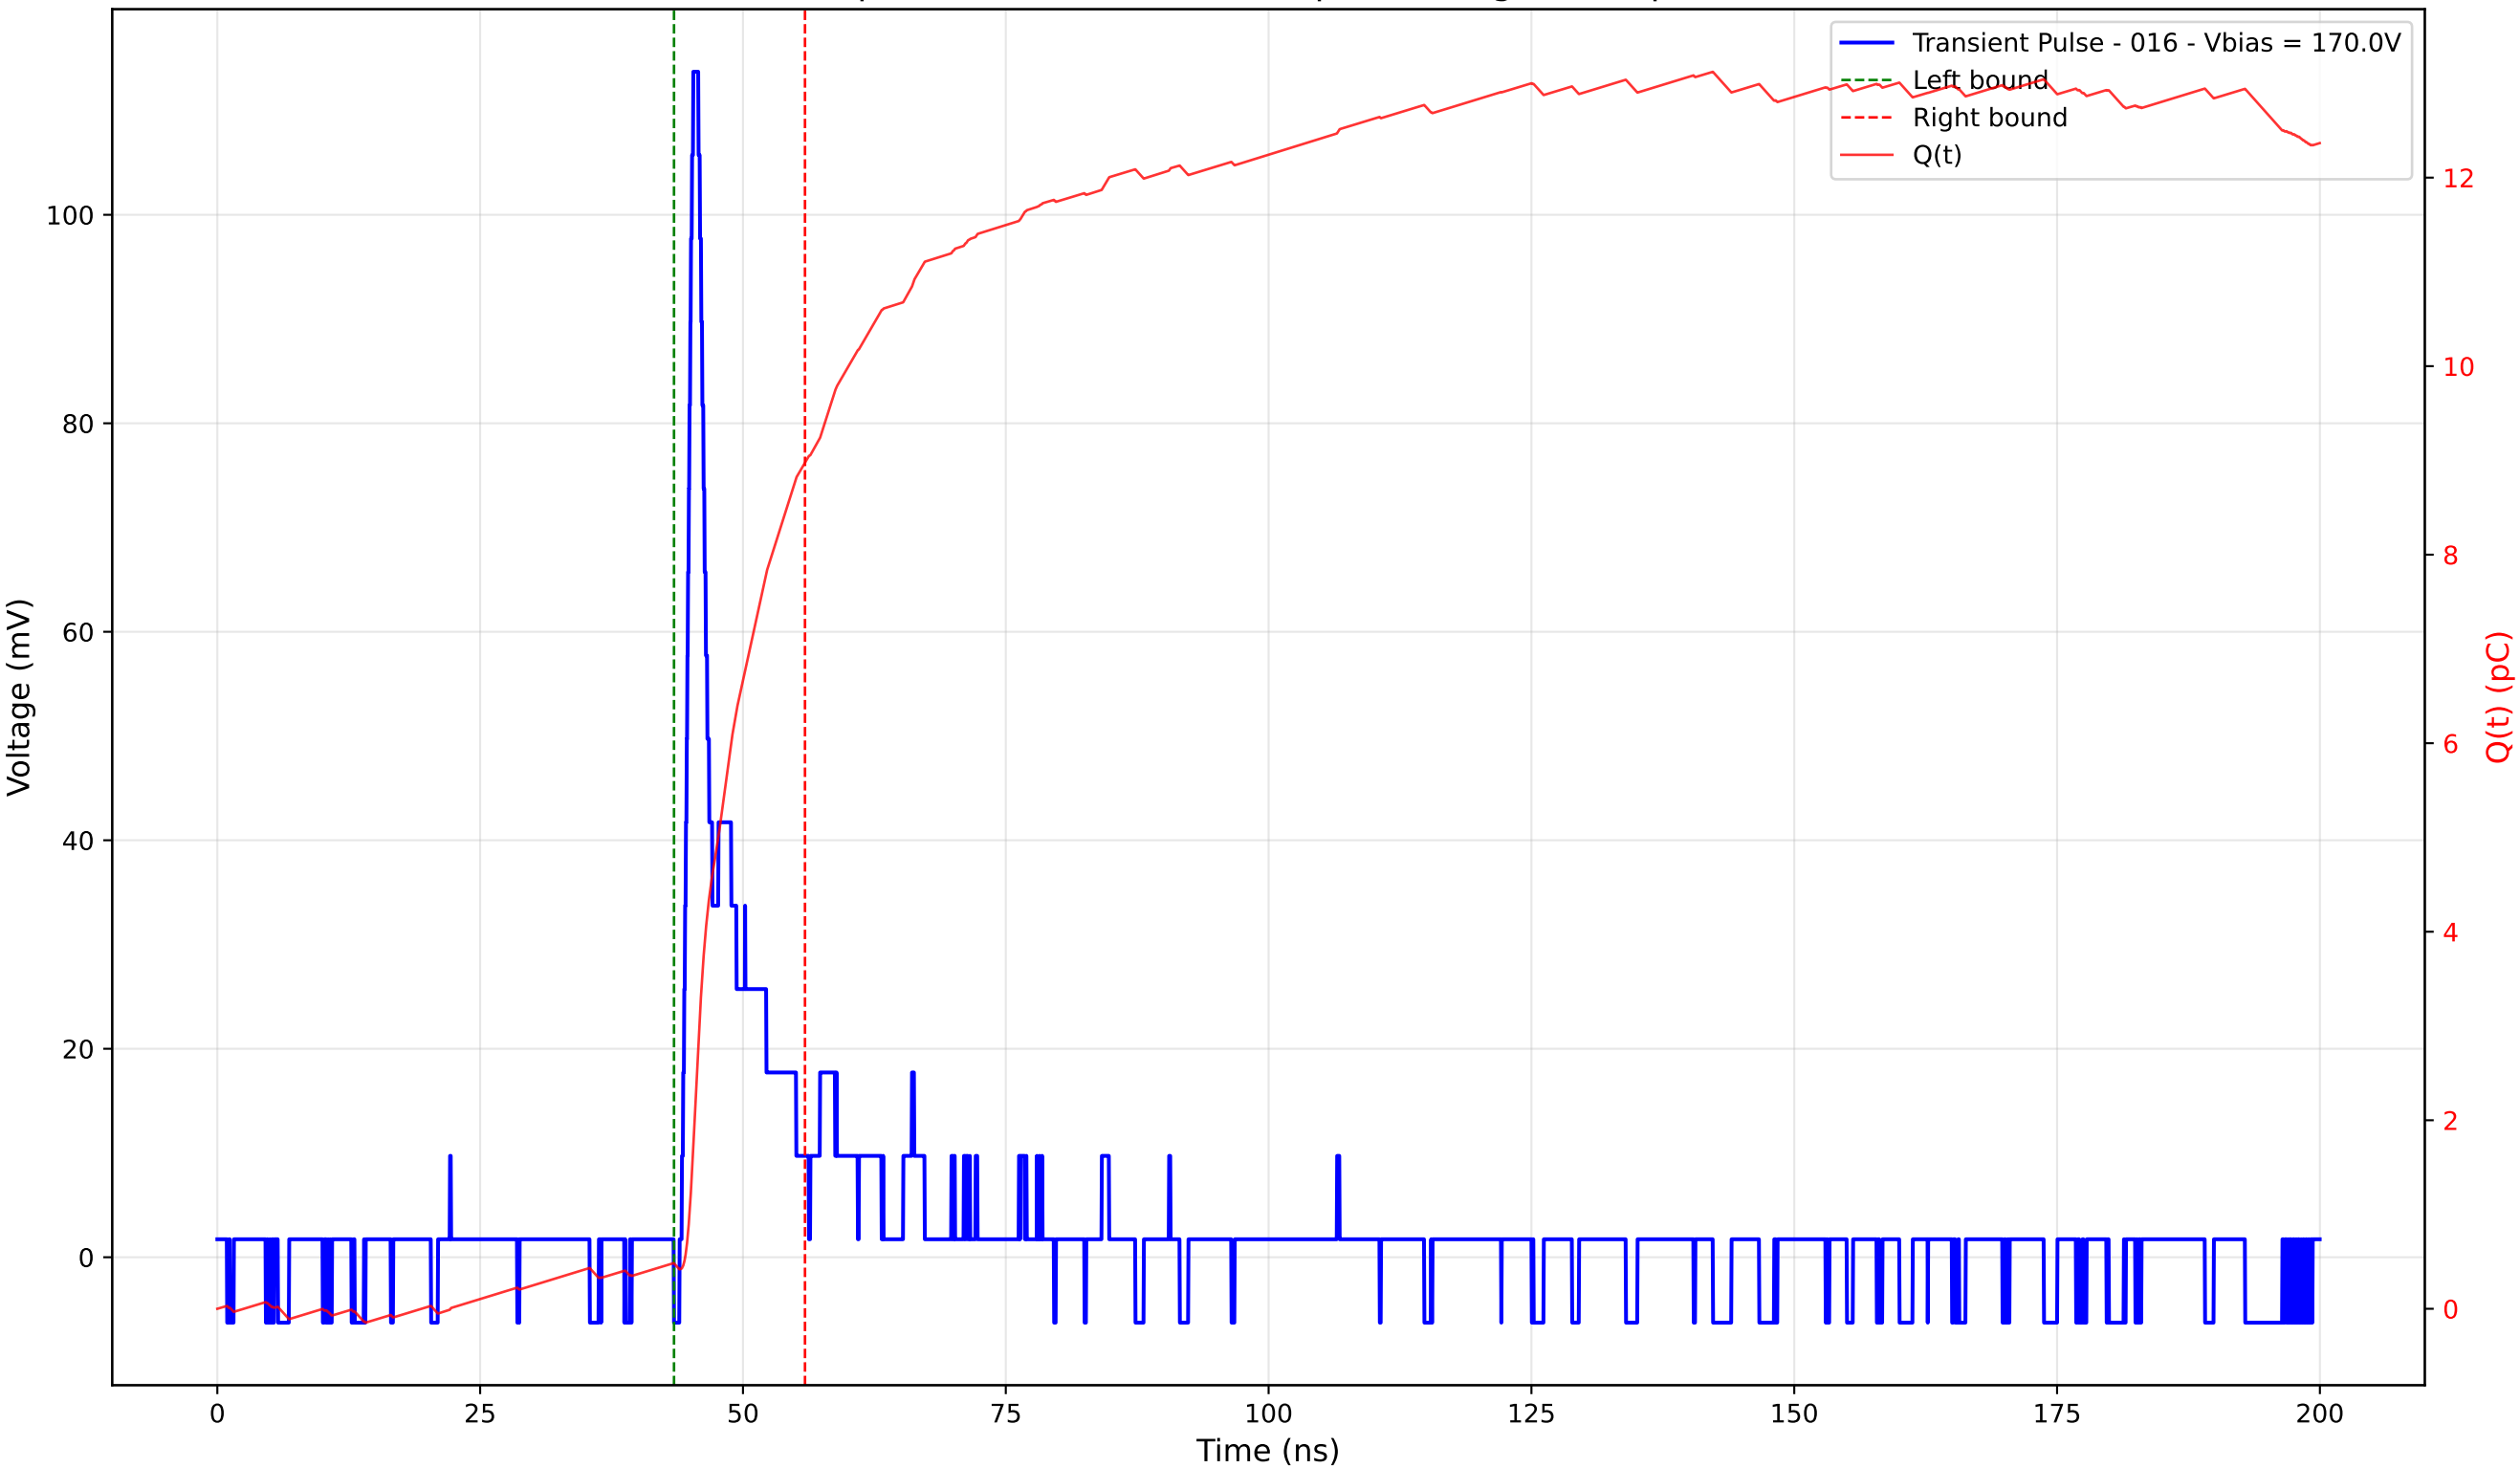


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 15.21 pC - Rise Time: 0.82 ns

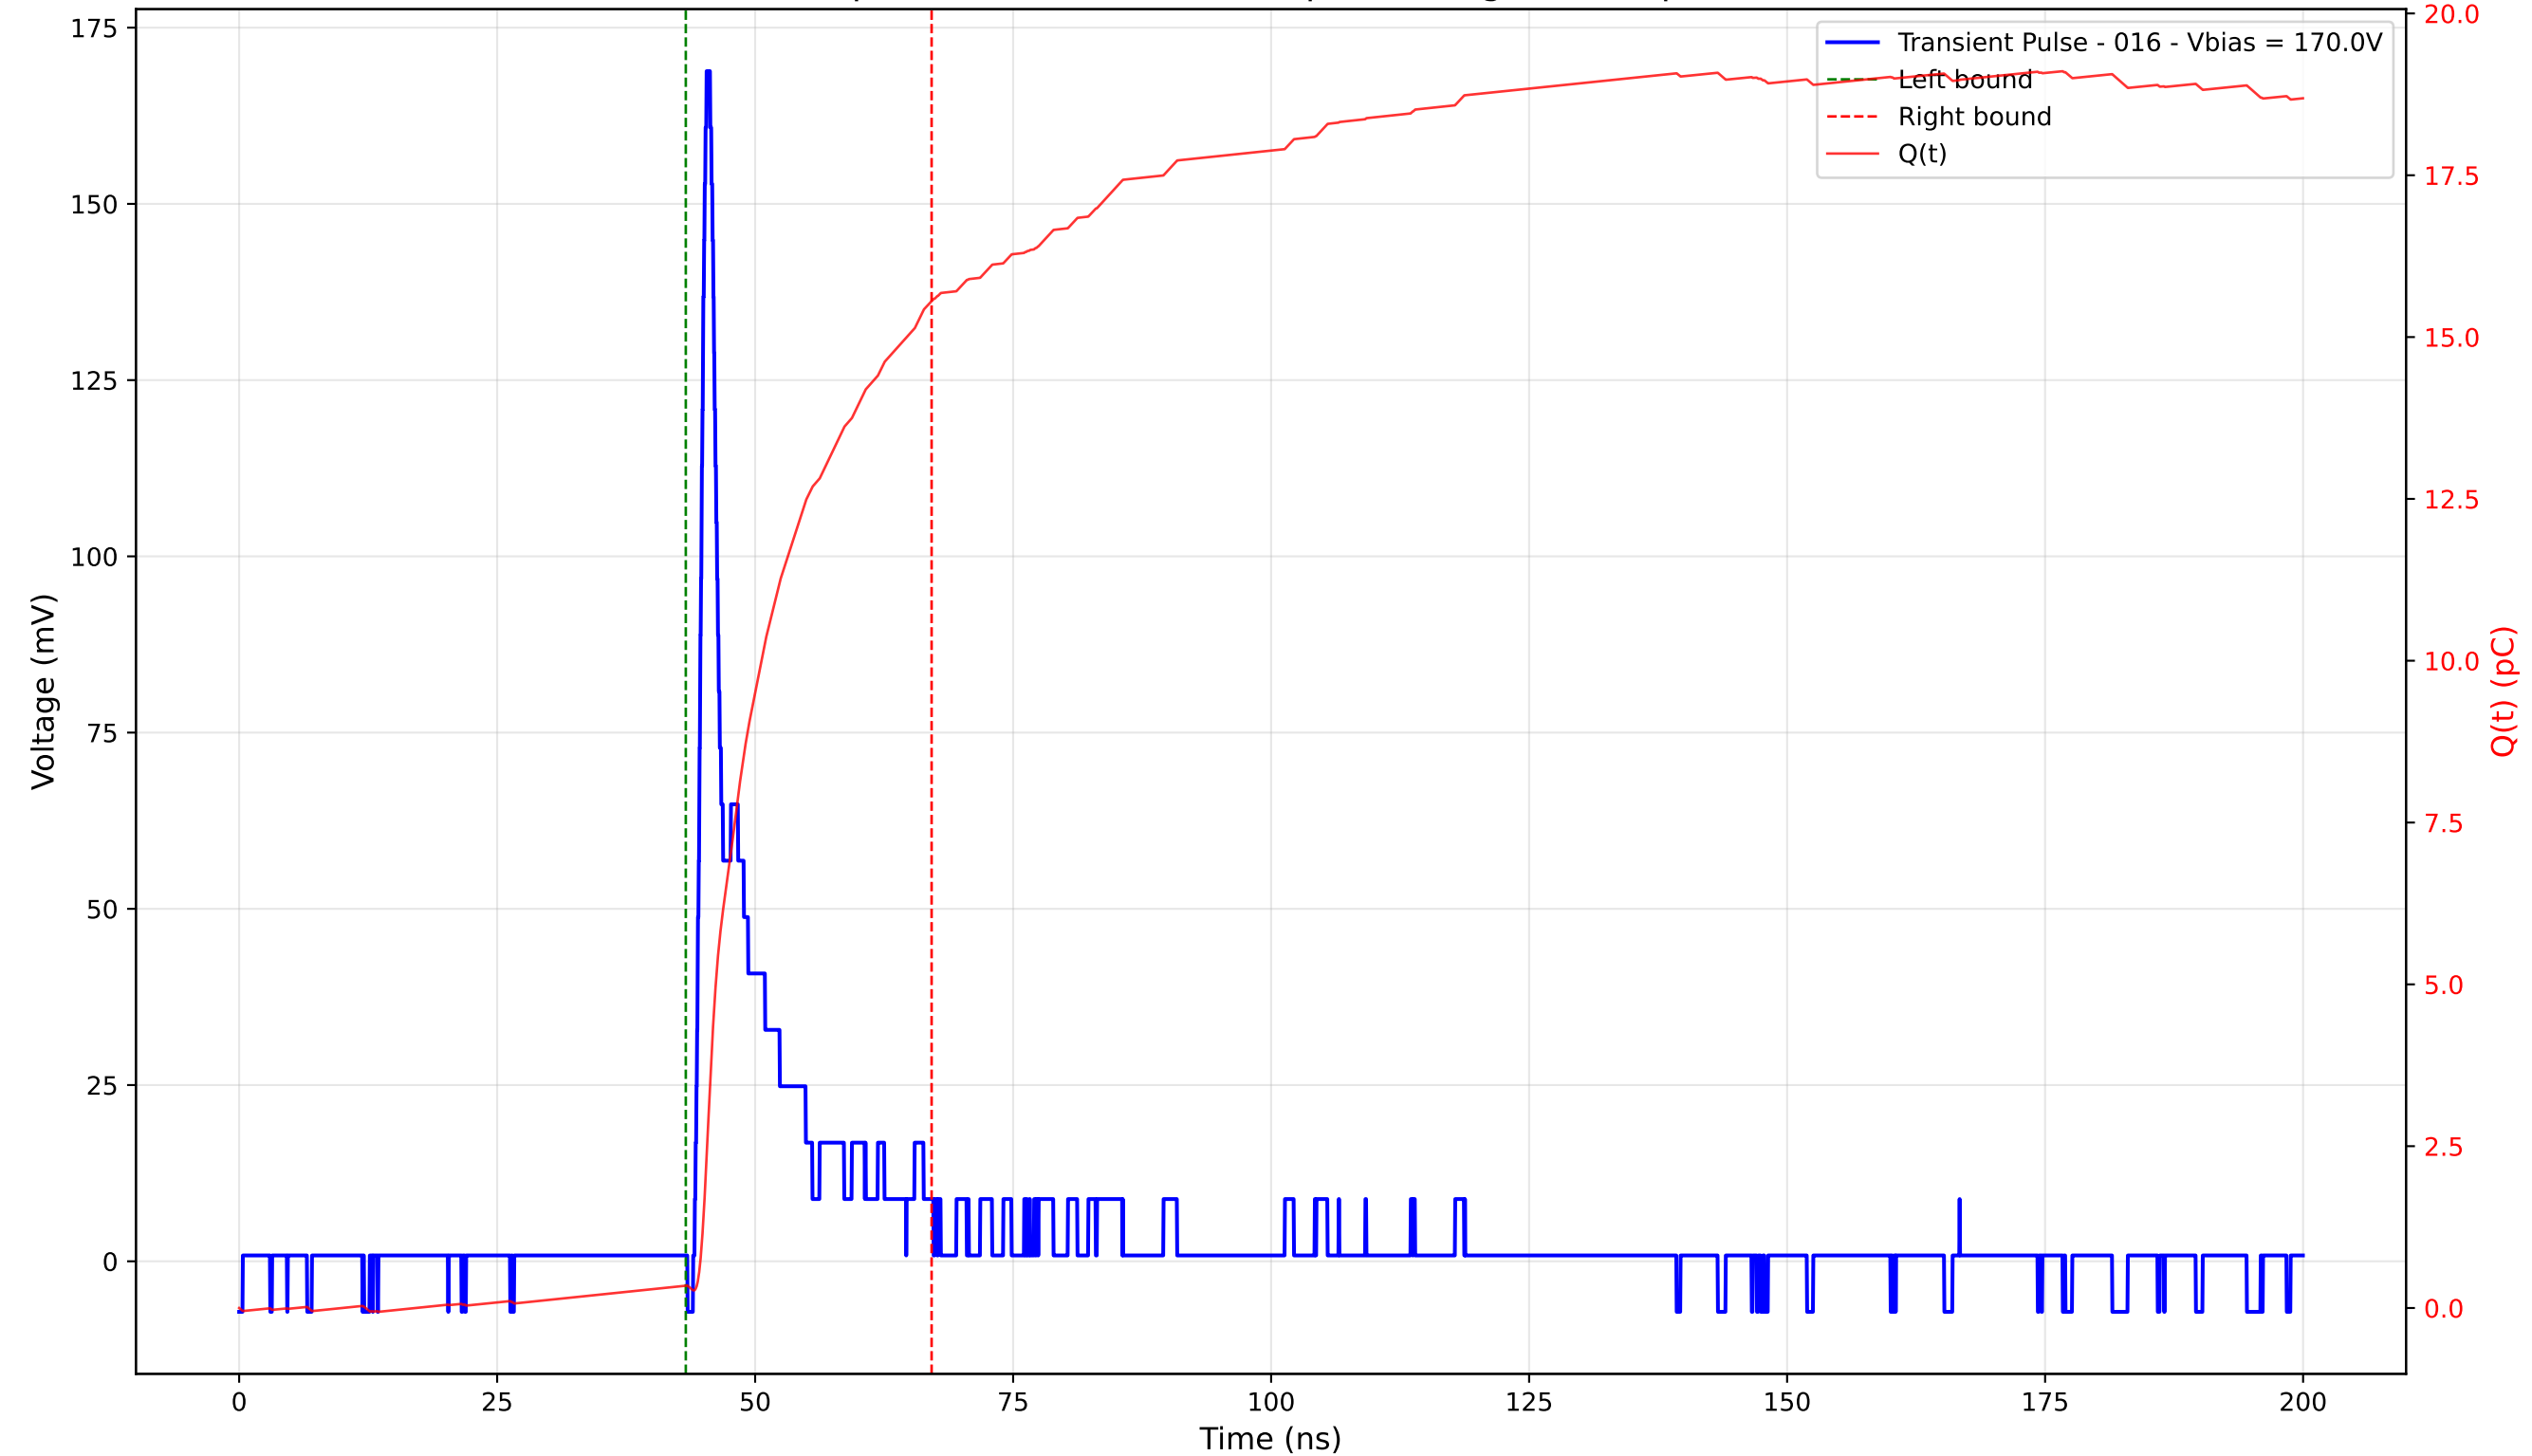


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 20.88 pC - Rise Time: 0.91 ns

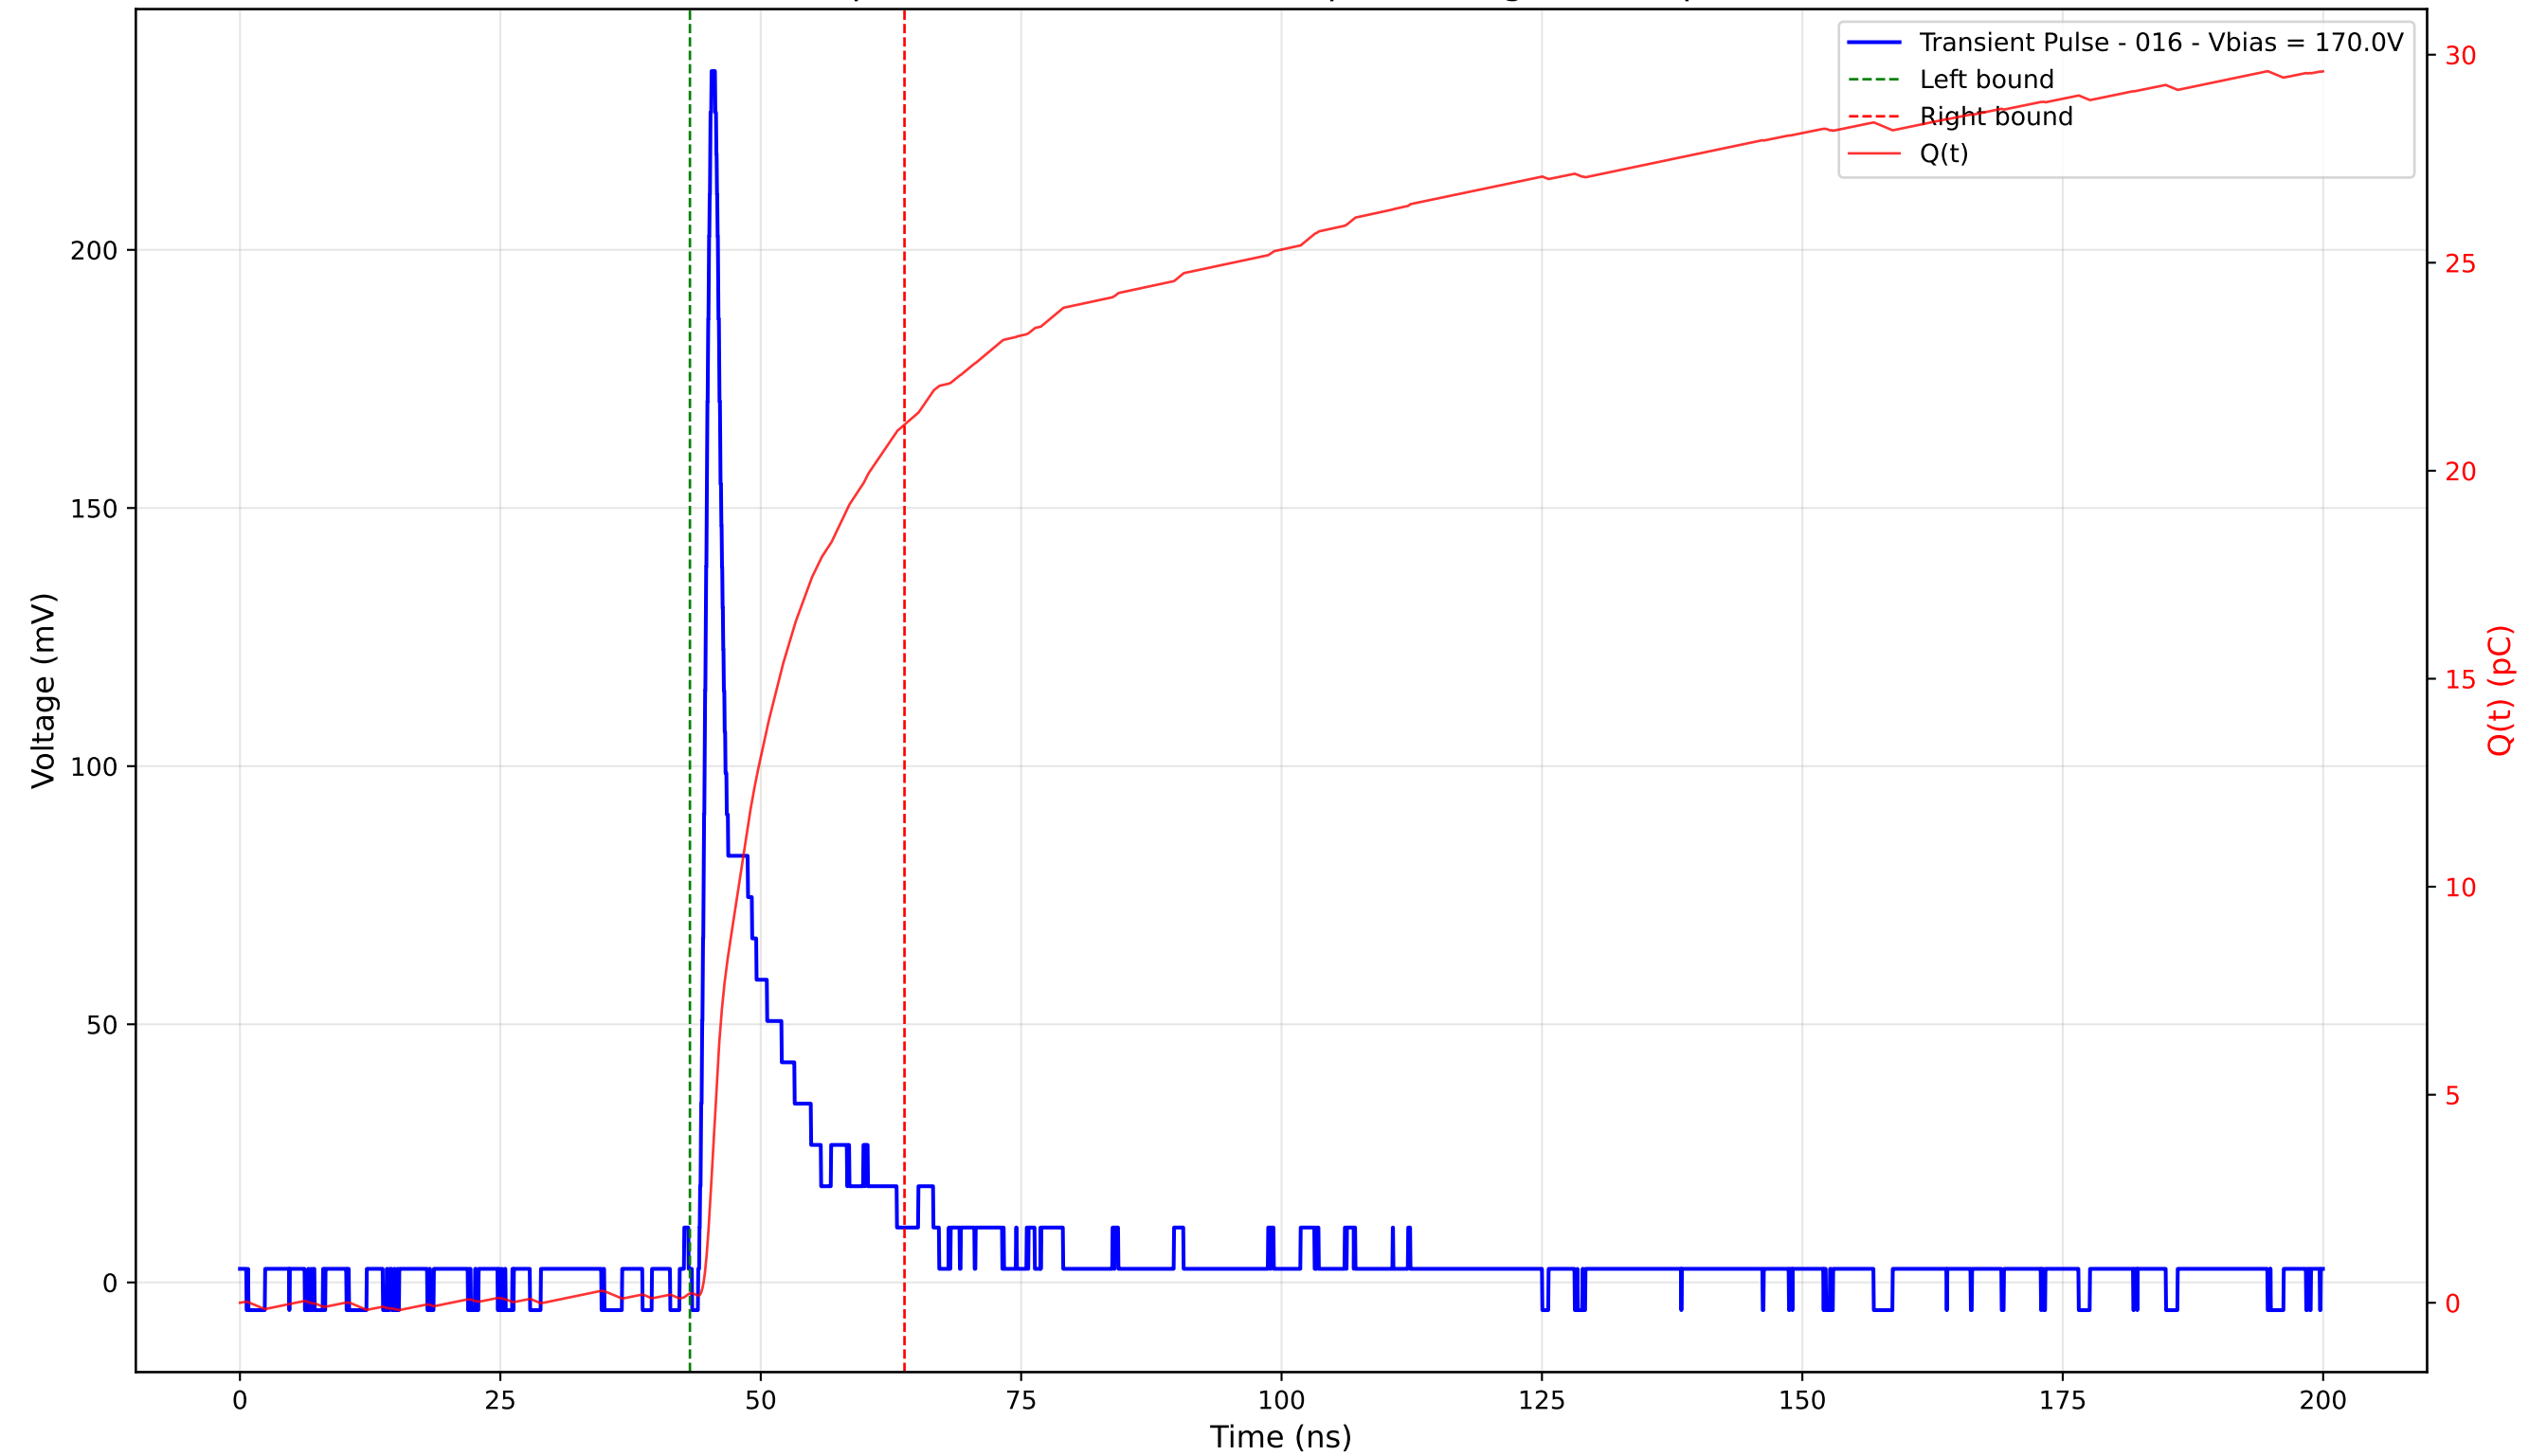


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 27.36 pC - Rise Time: 0.91 ns

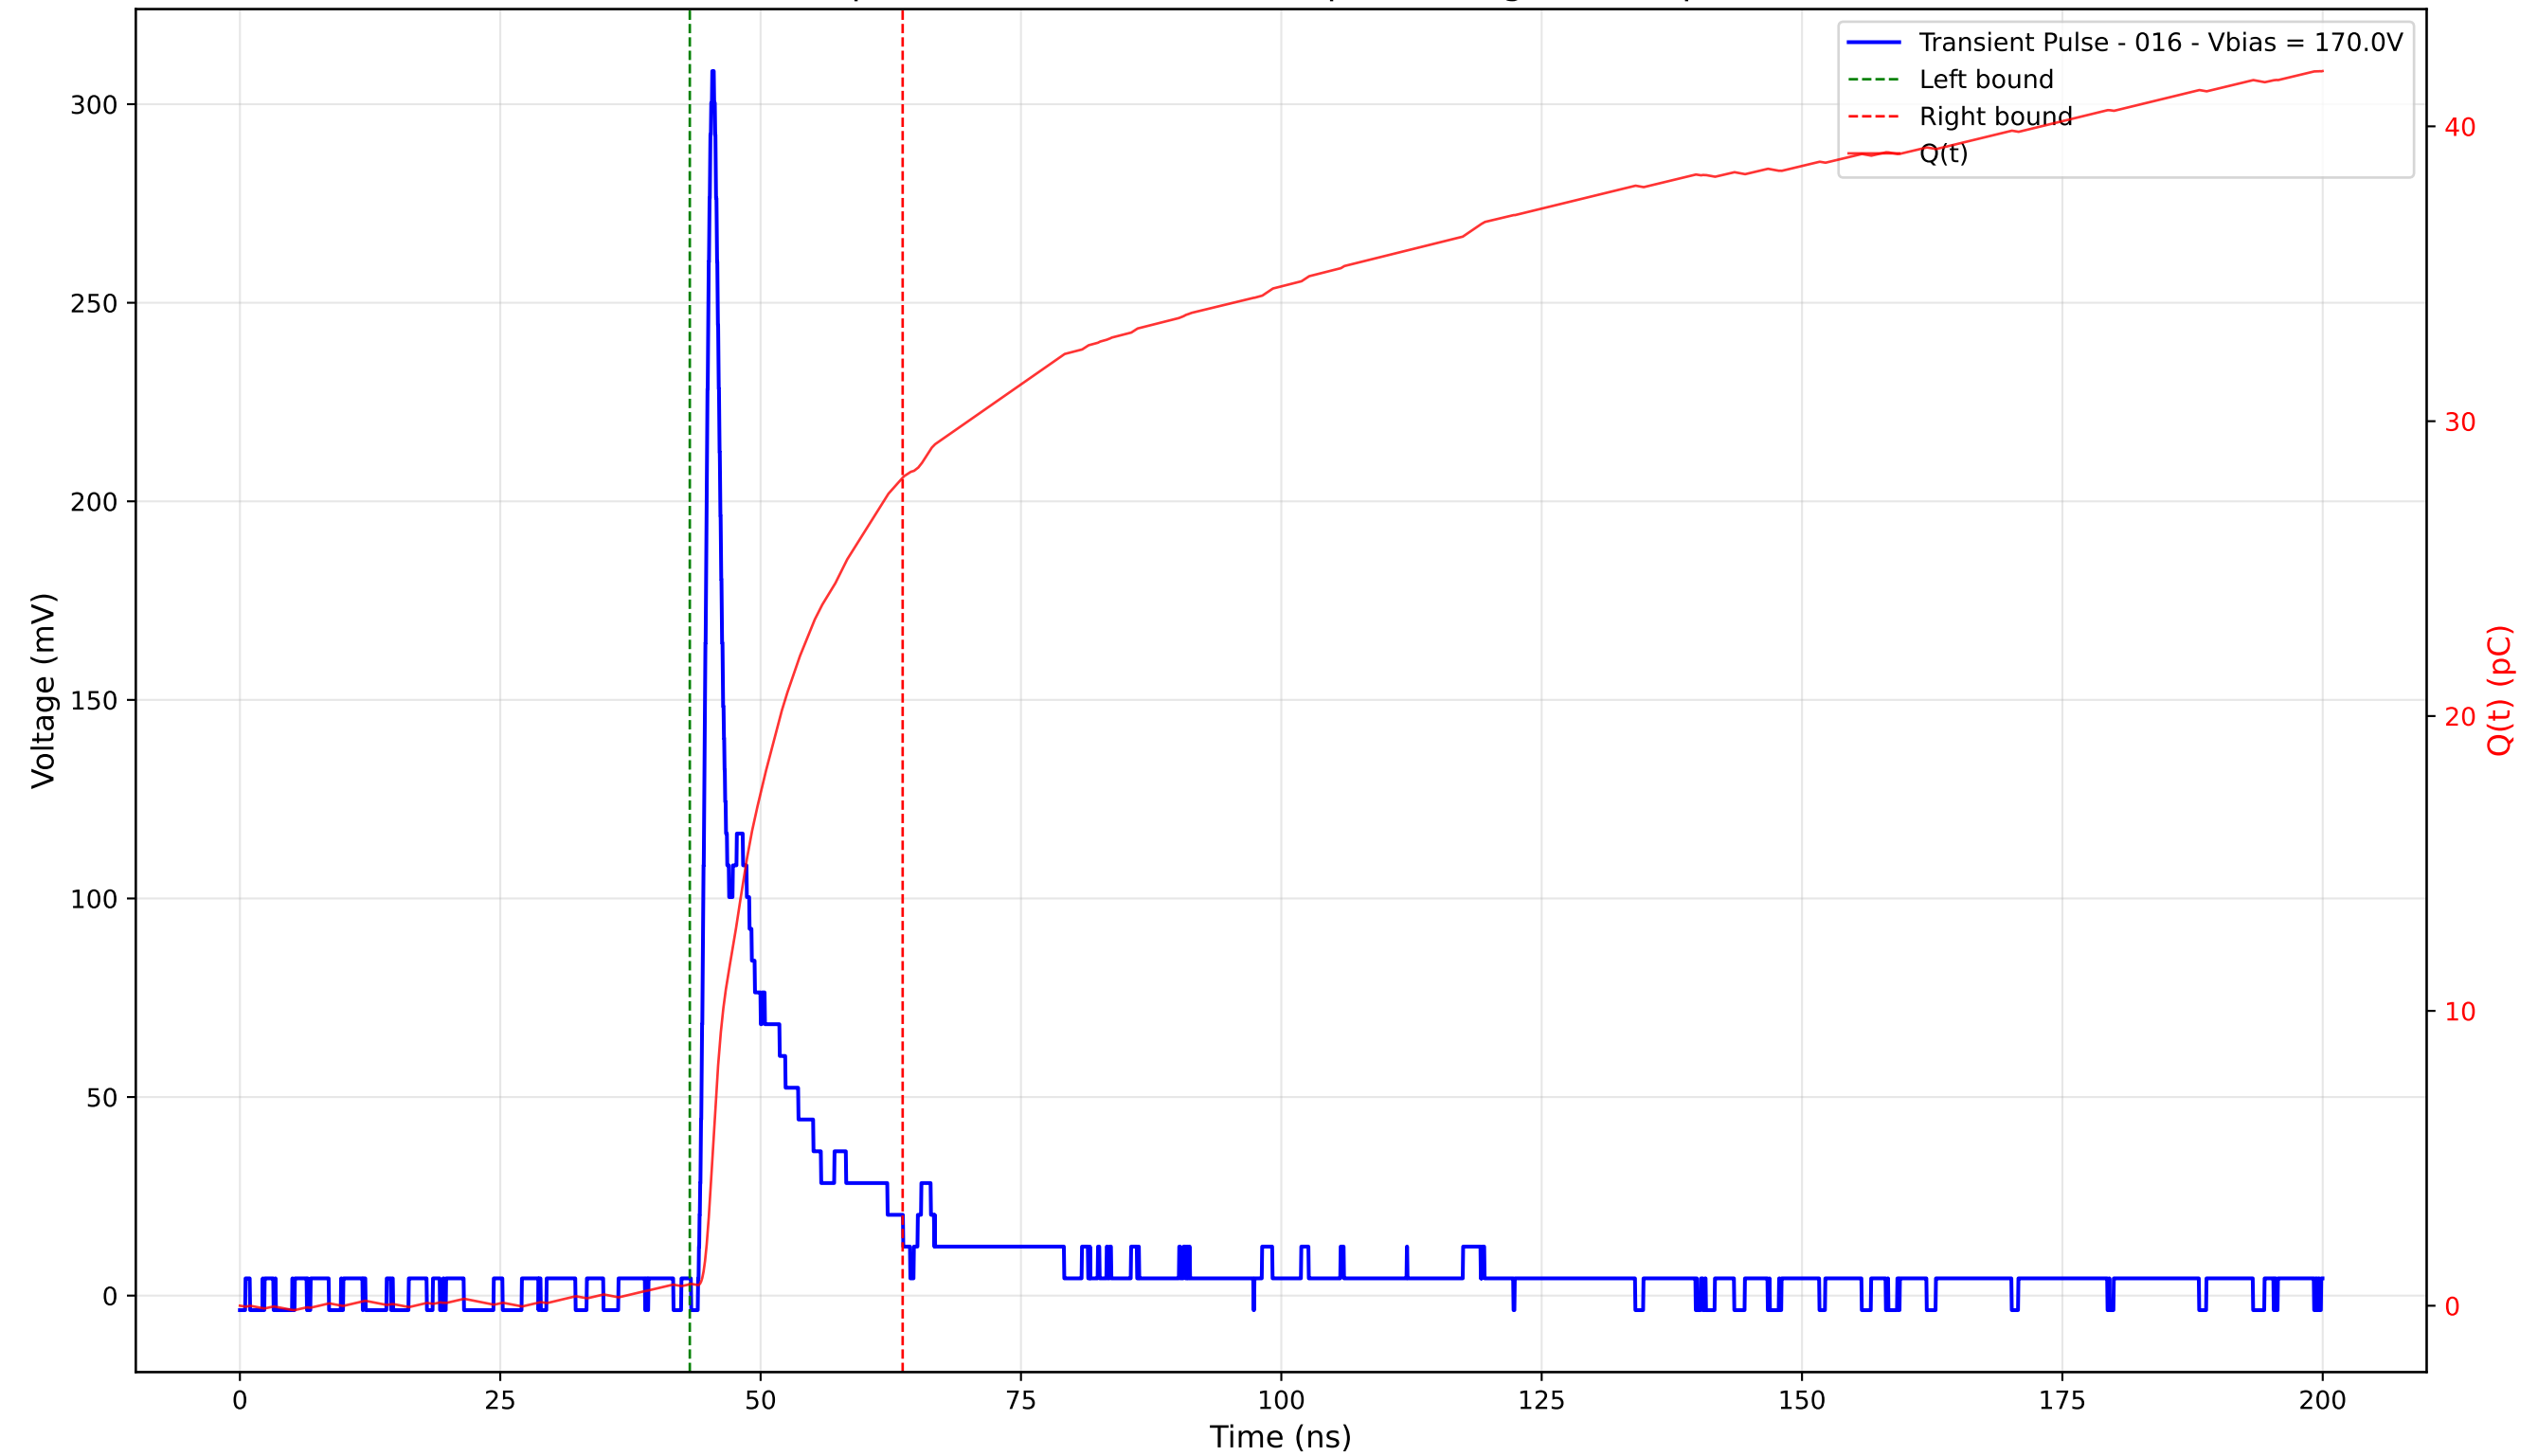


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 32.32 pC - Rise Time: 0.91 ns

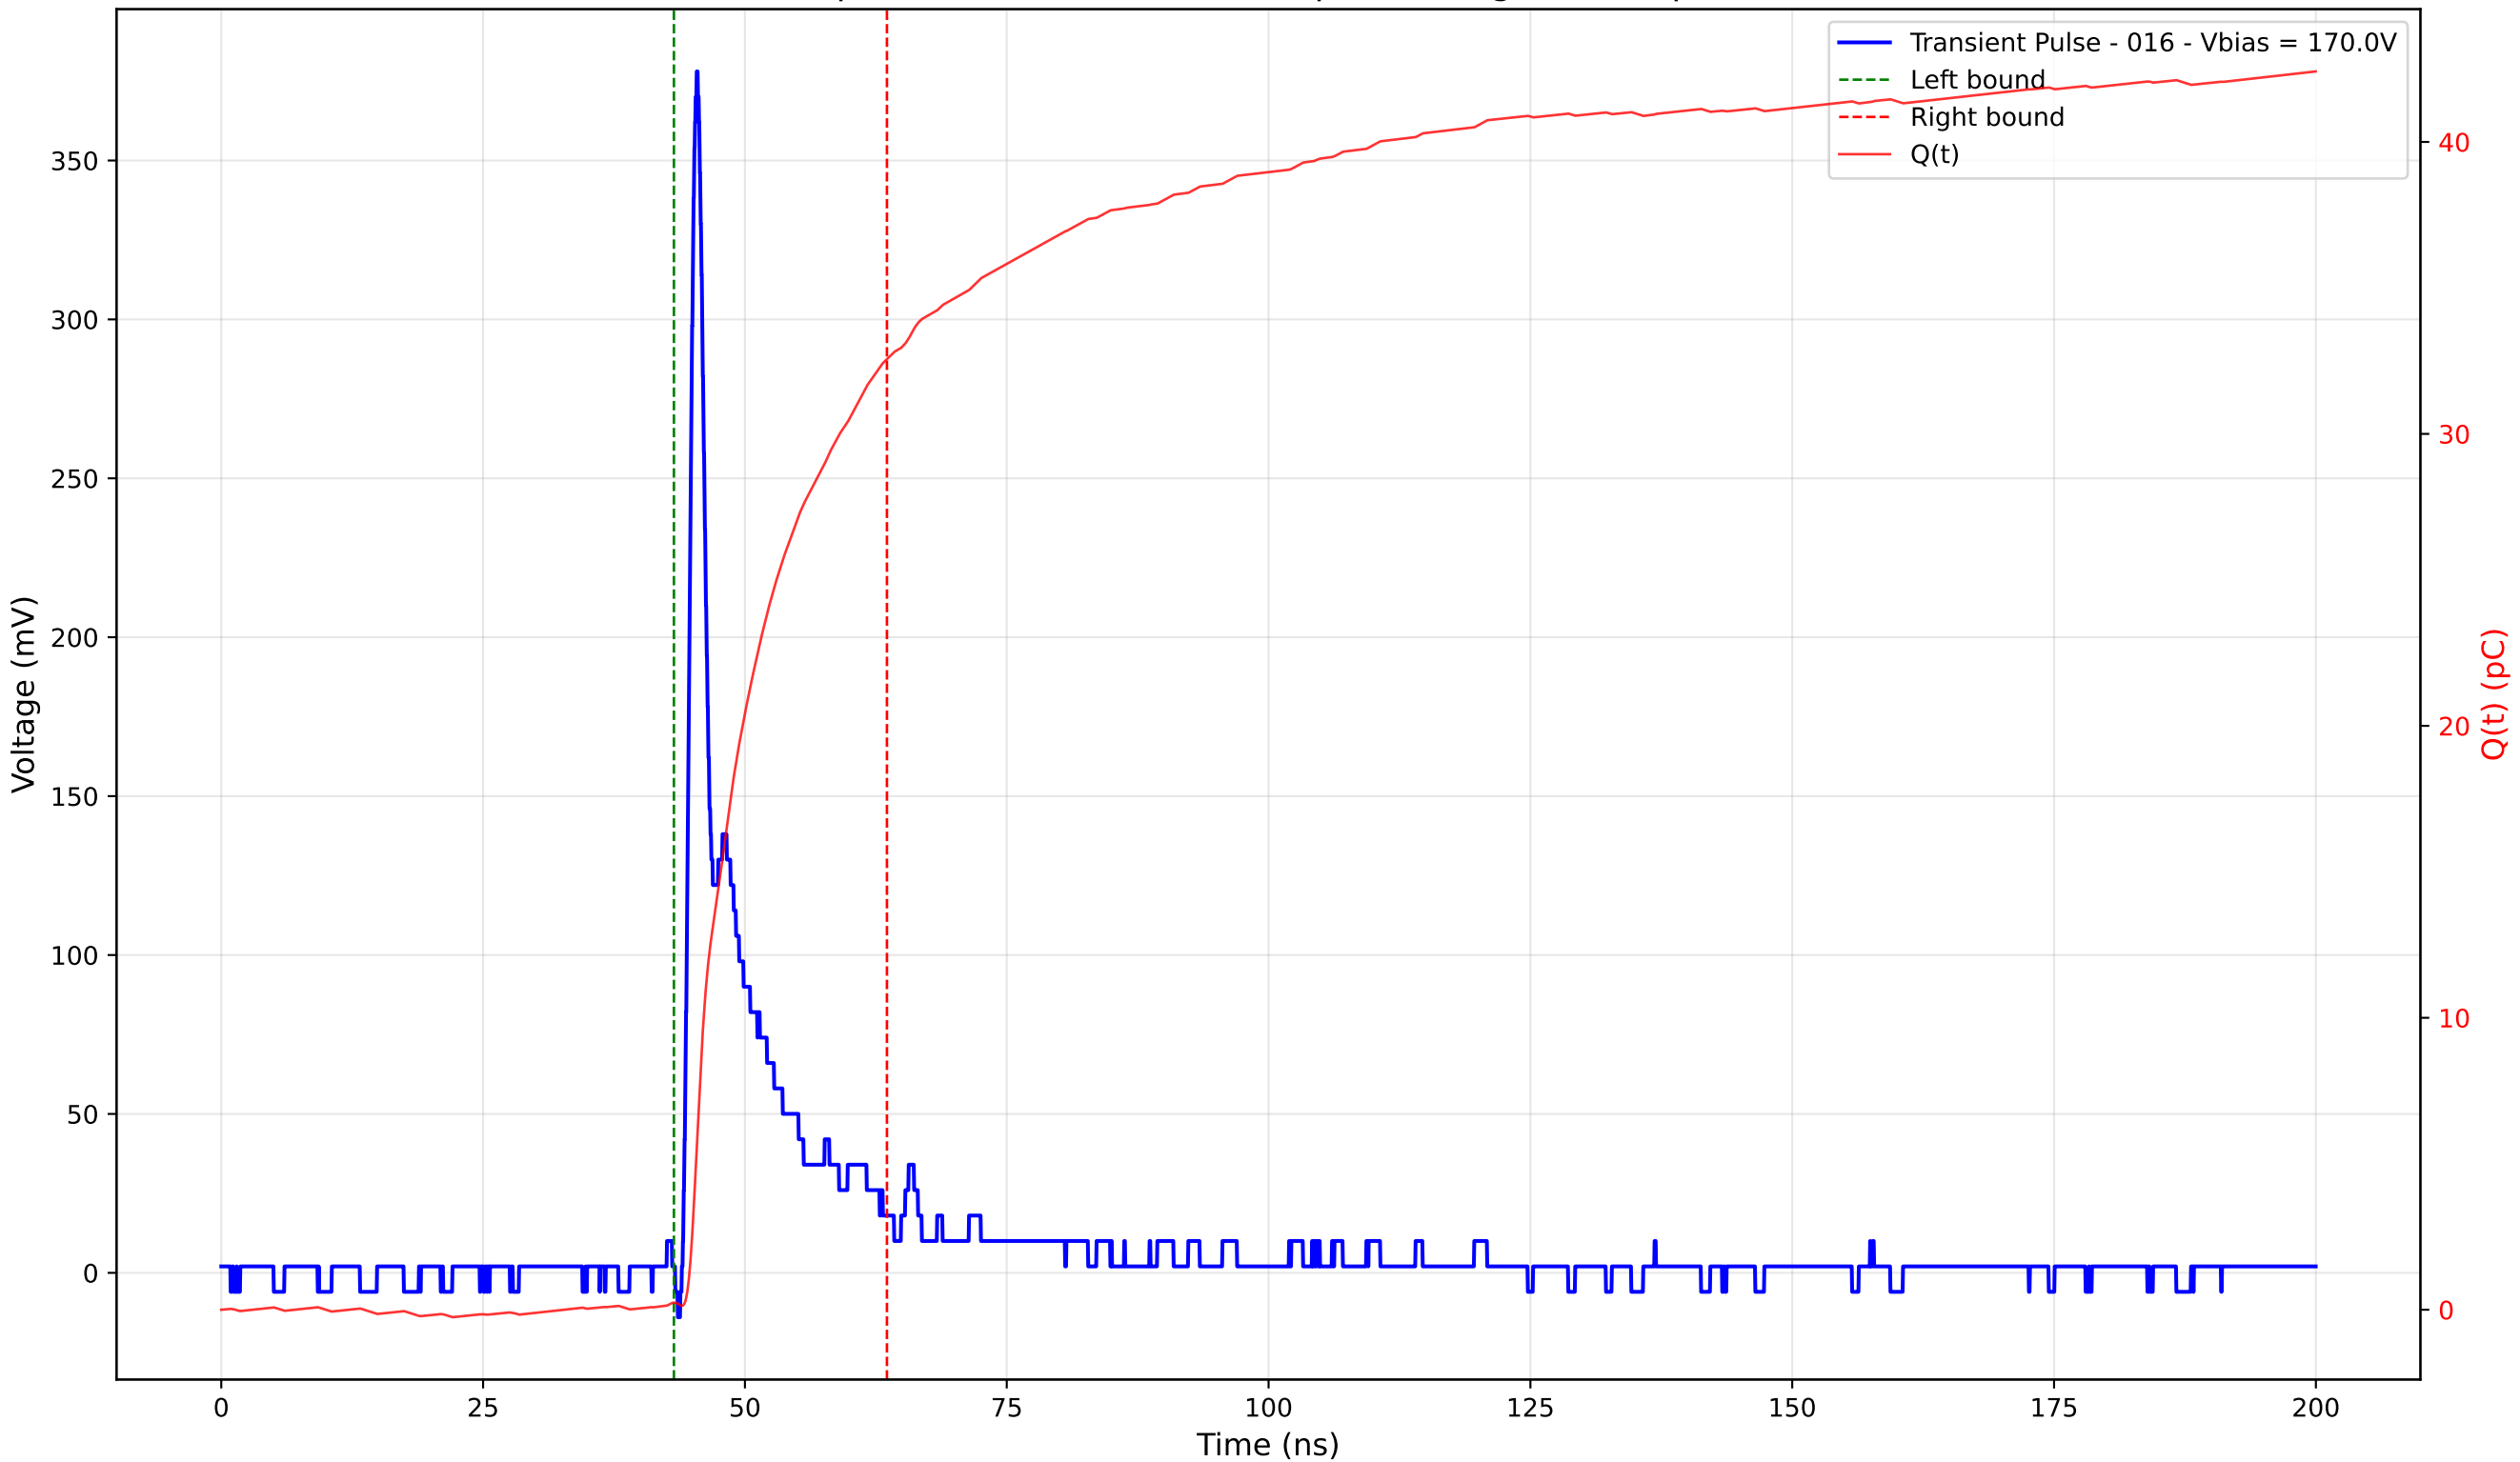


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 38.42 pC - Rise Time: 0.90 ns

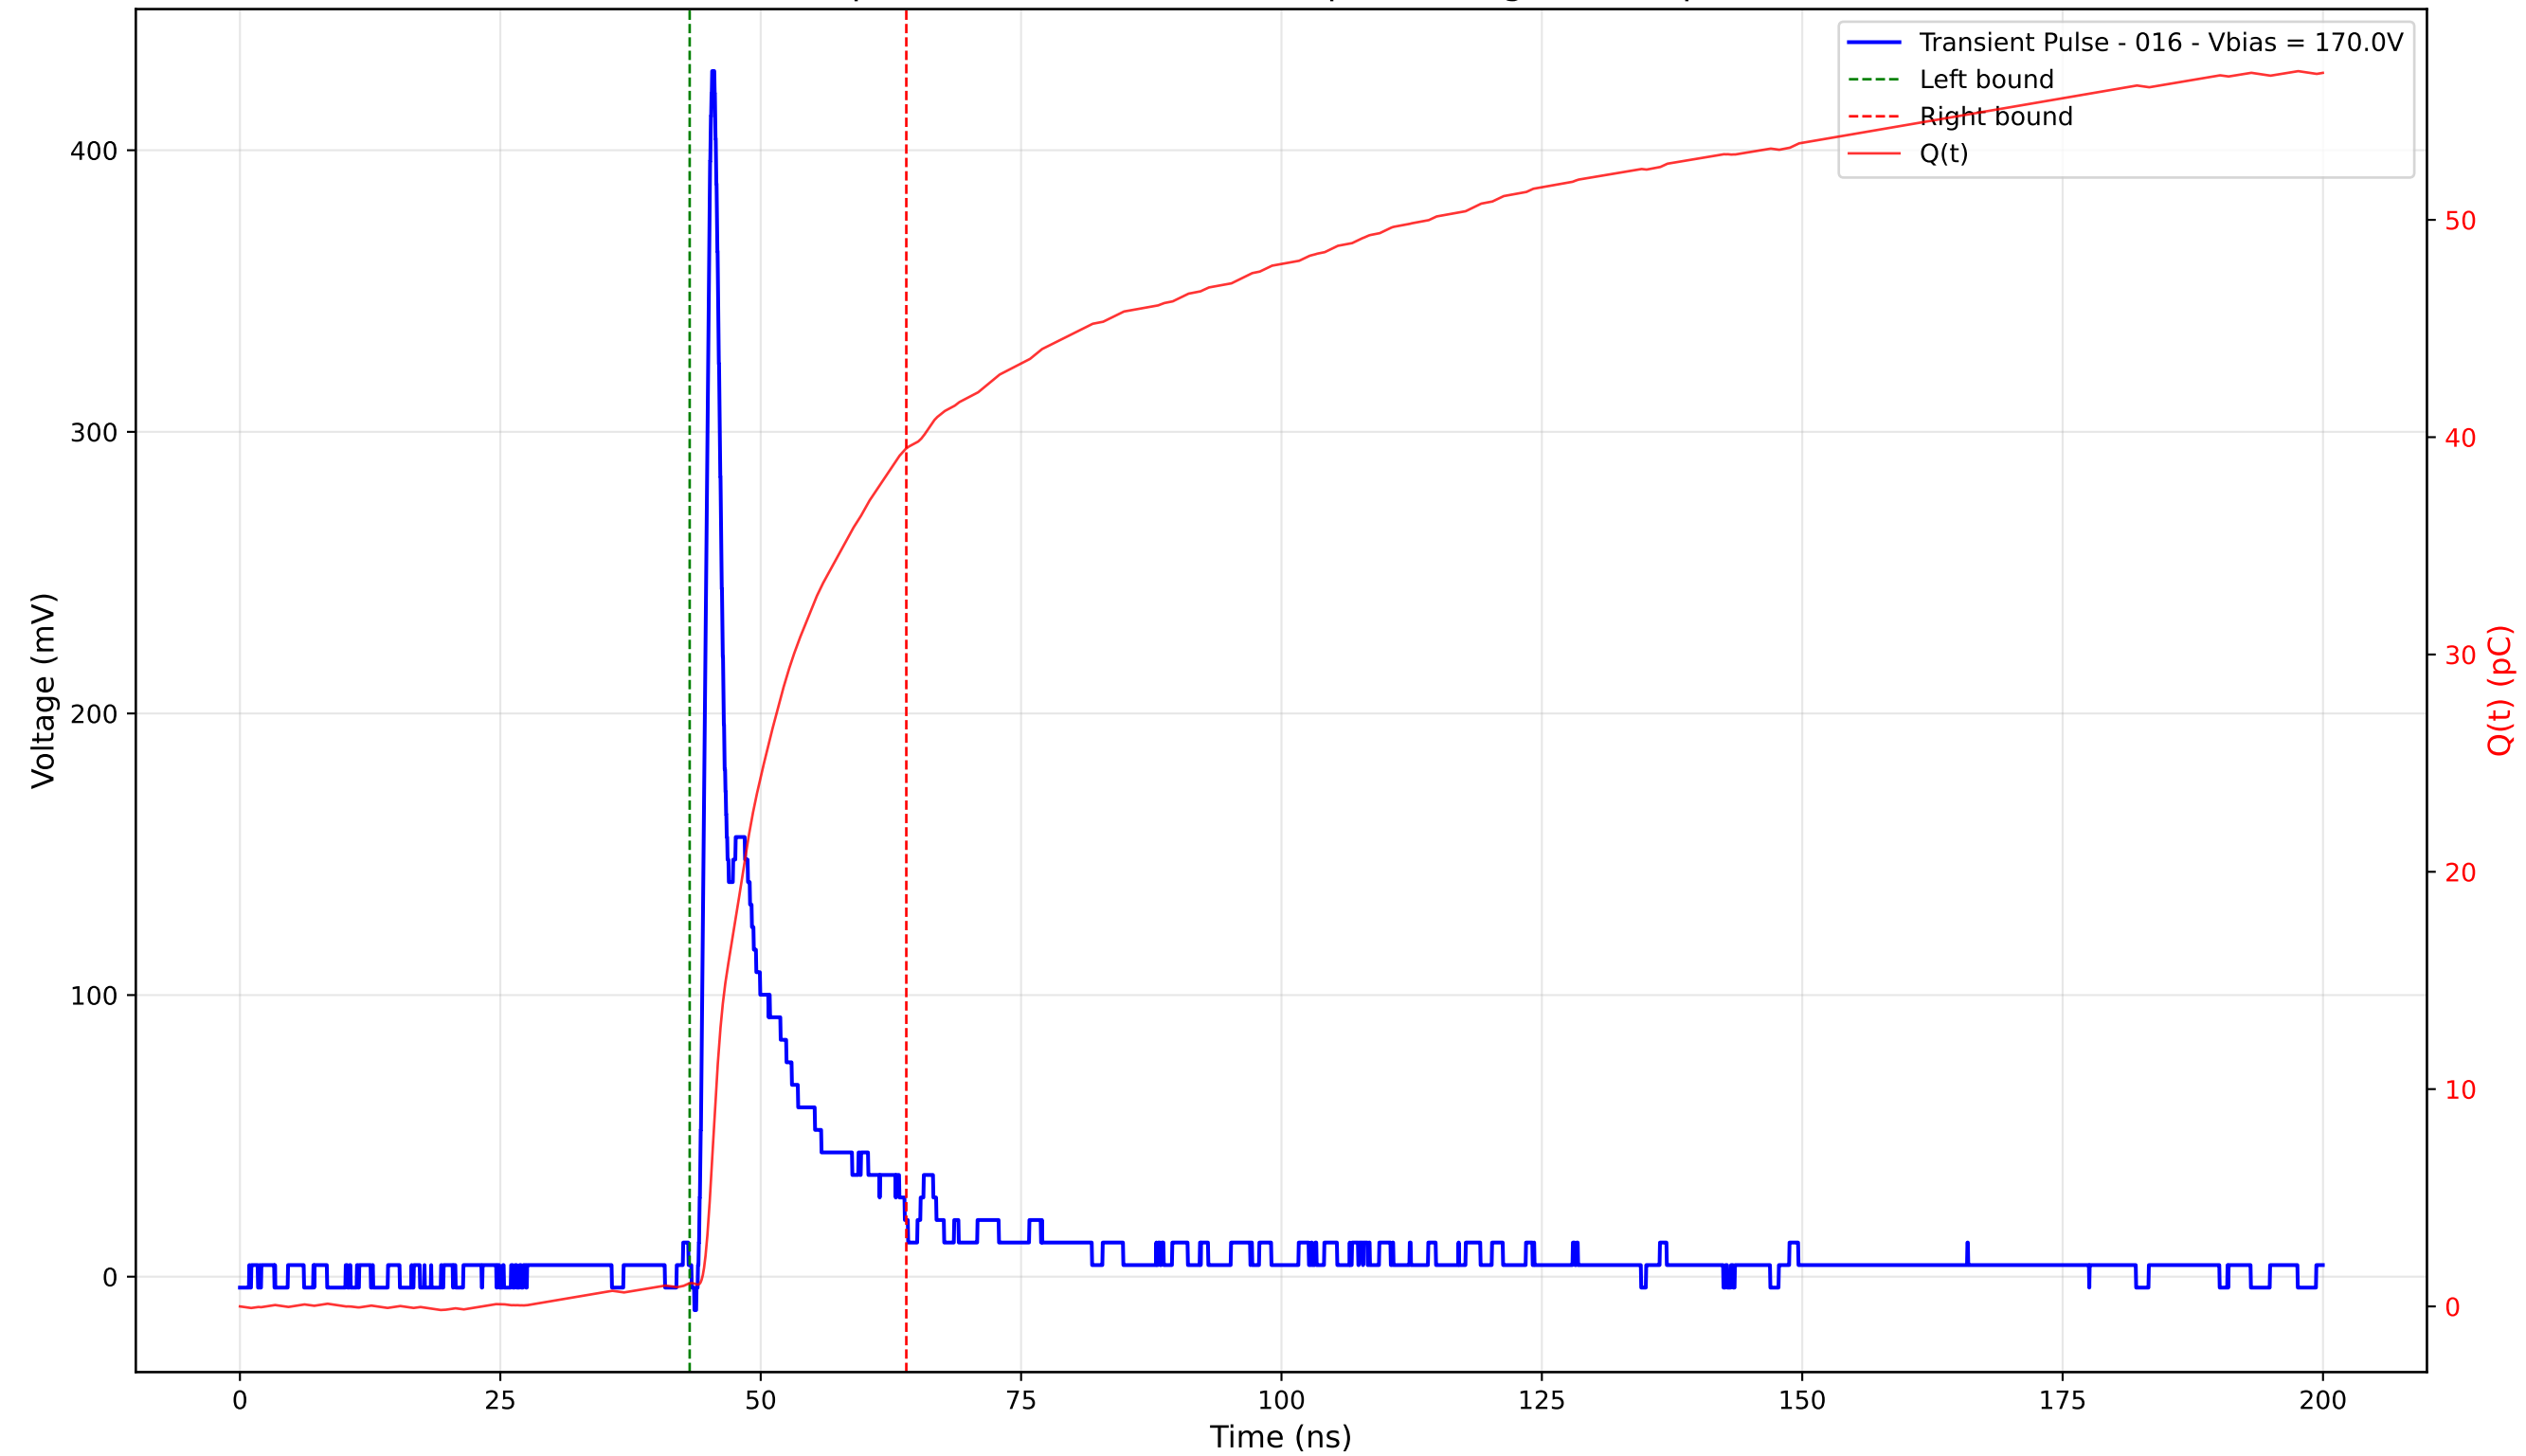


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 39.71 pC - Rise Time: 0.88 ns

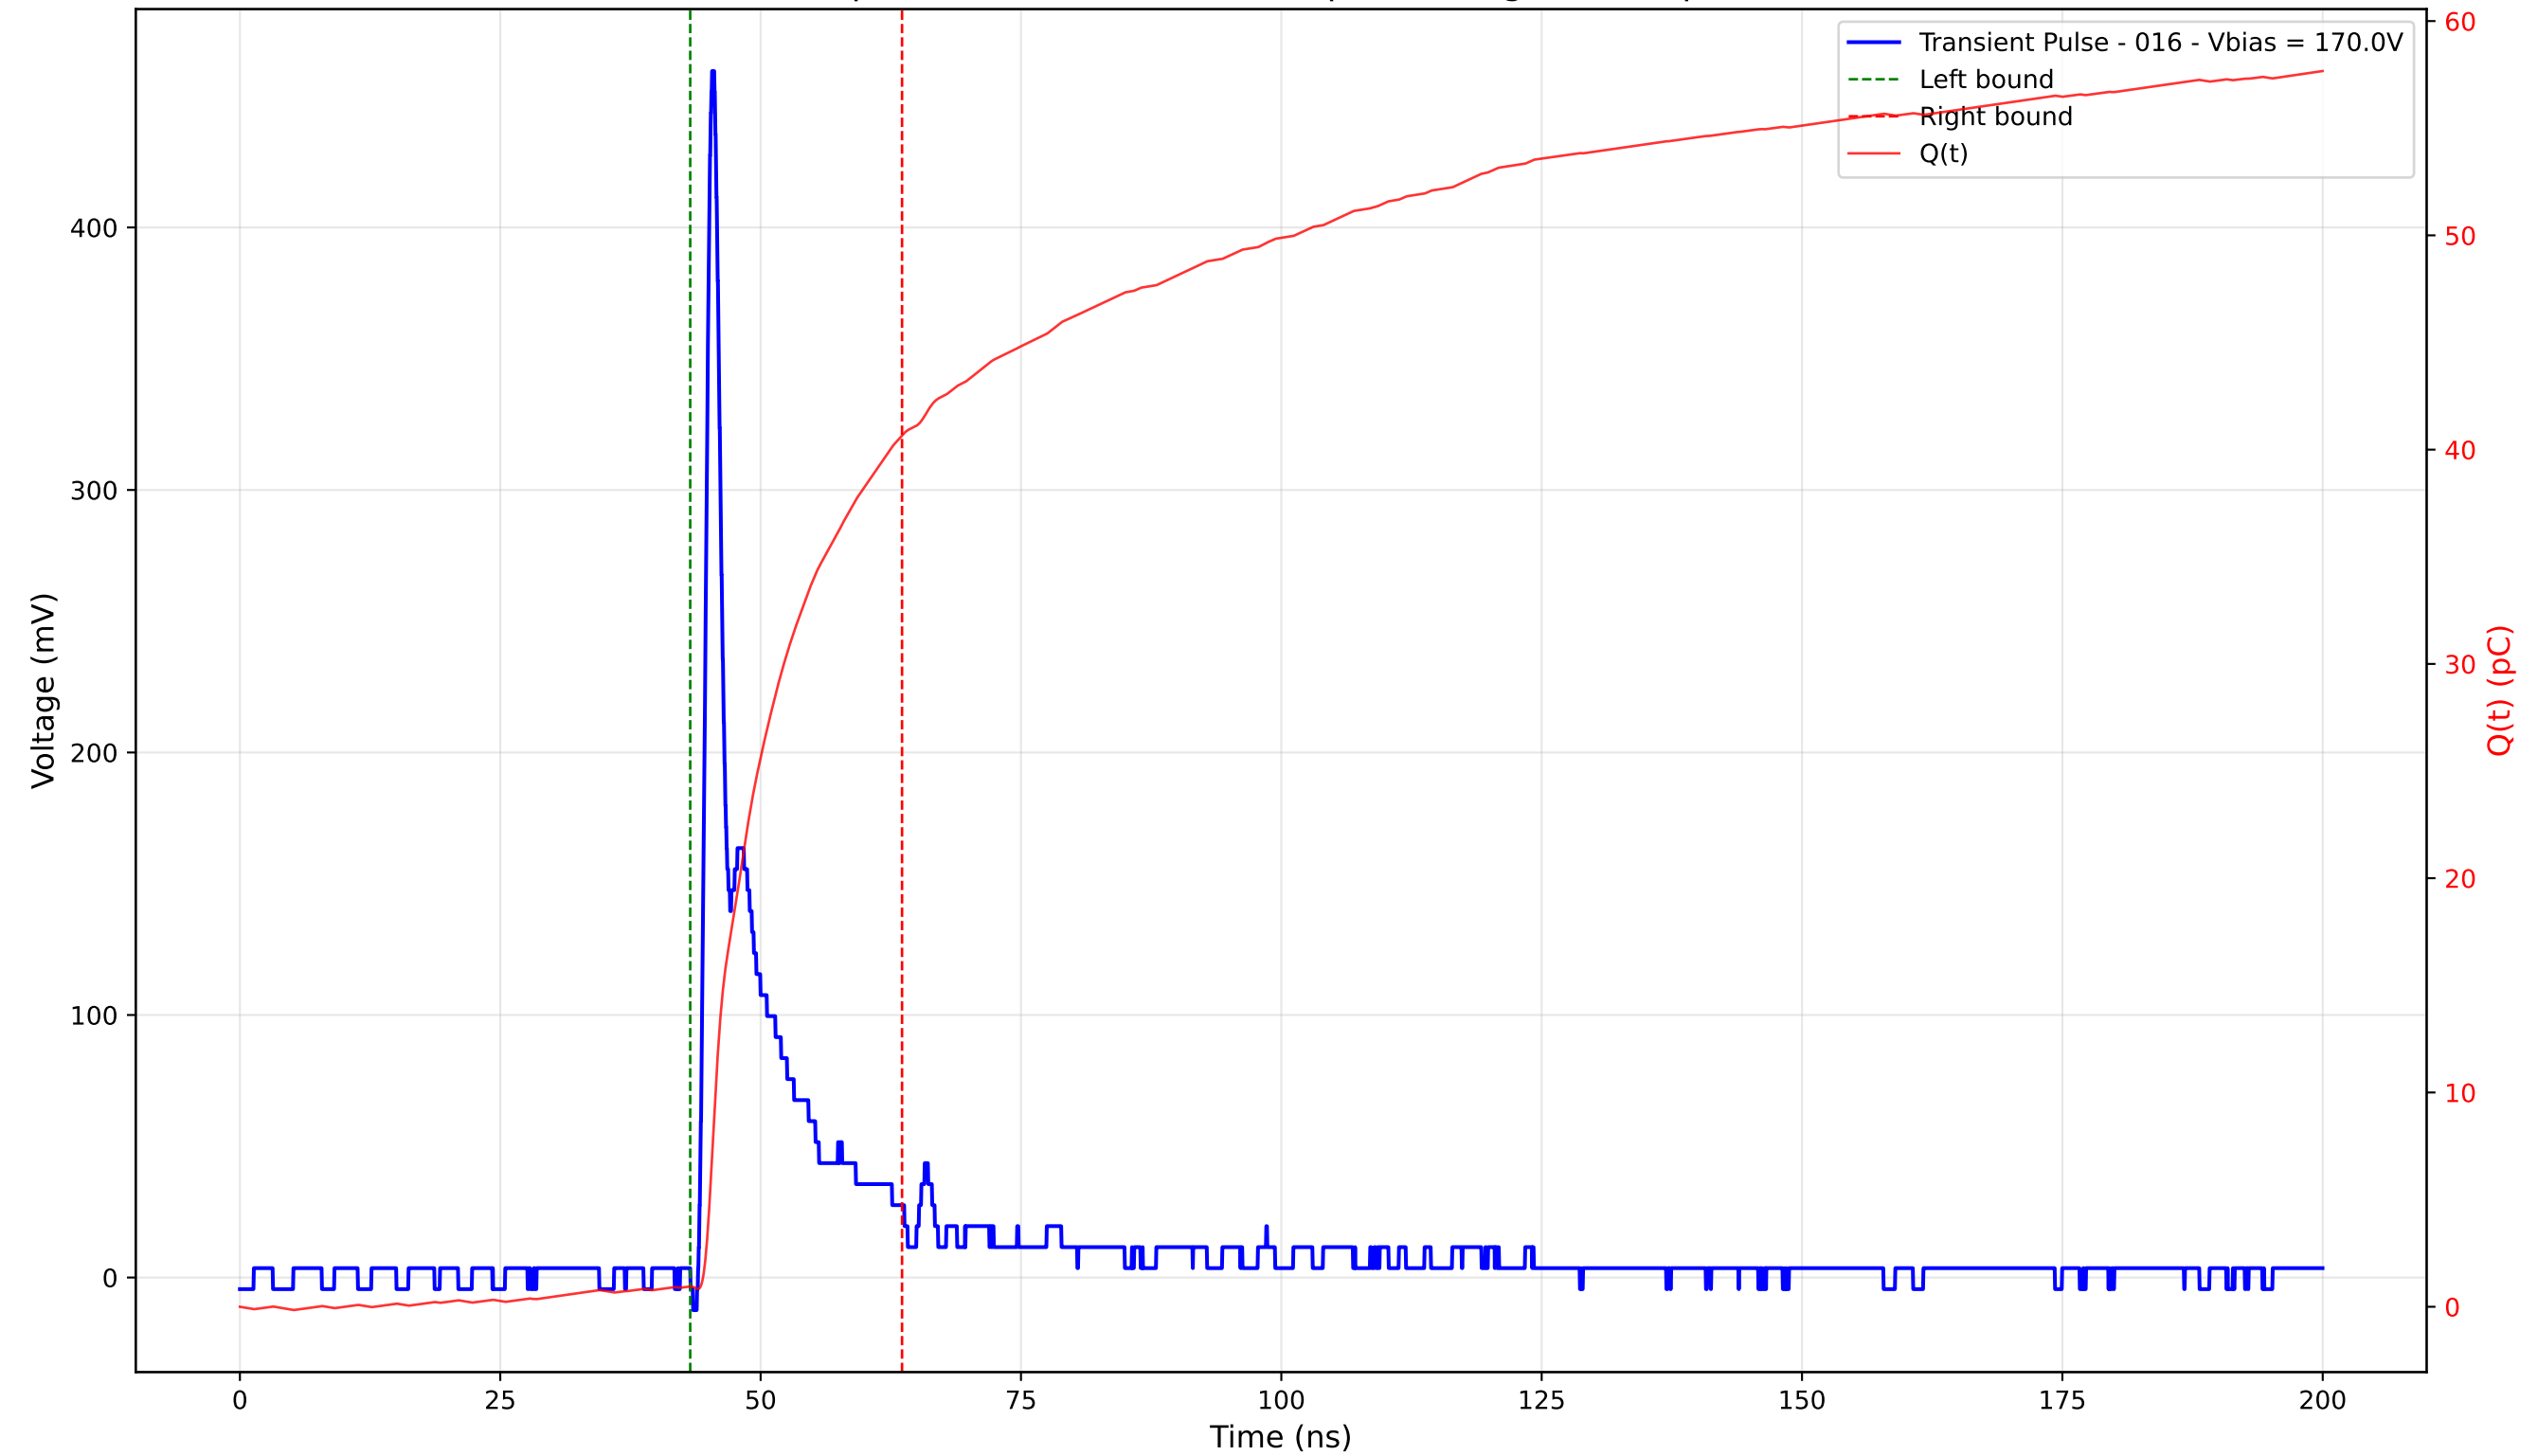


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 40.75 pC - Rise Time: 0.91 ns

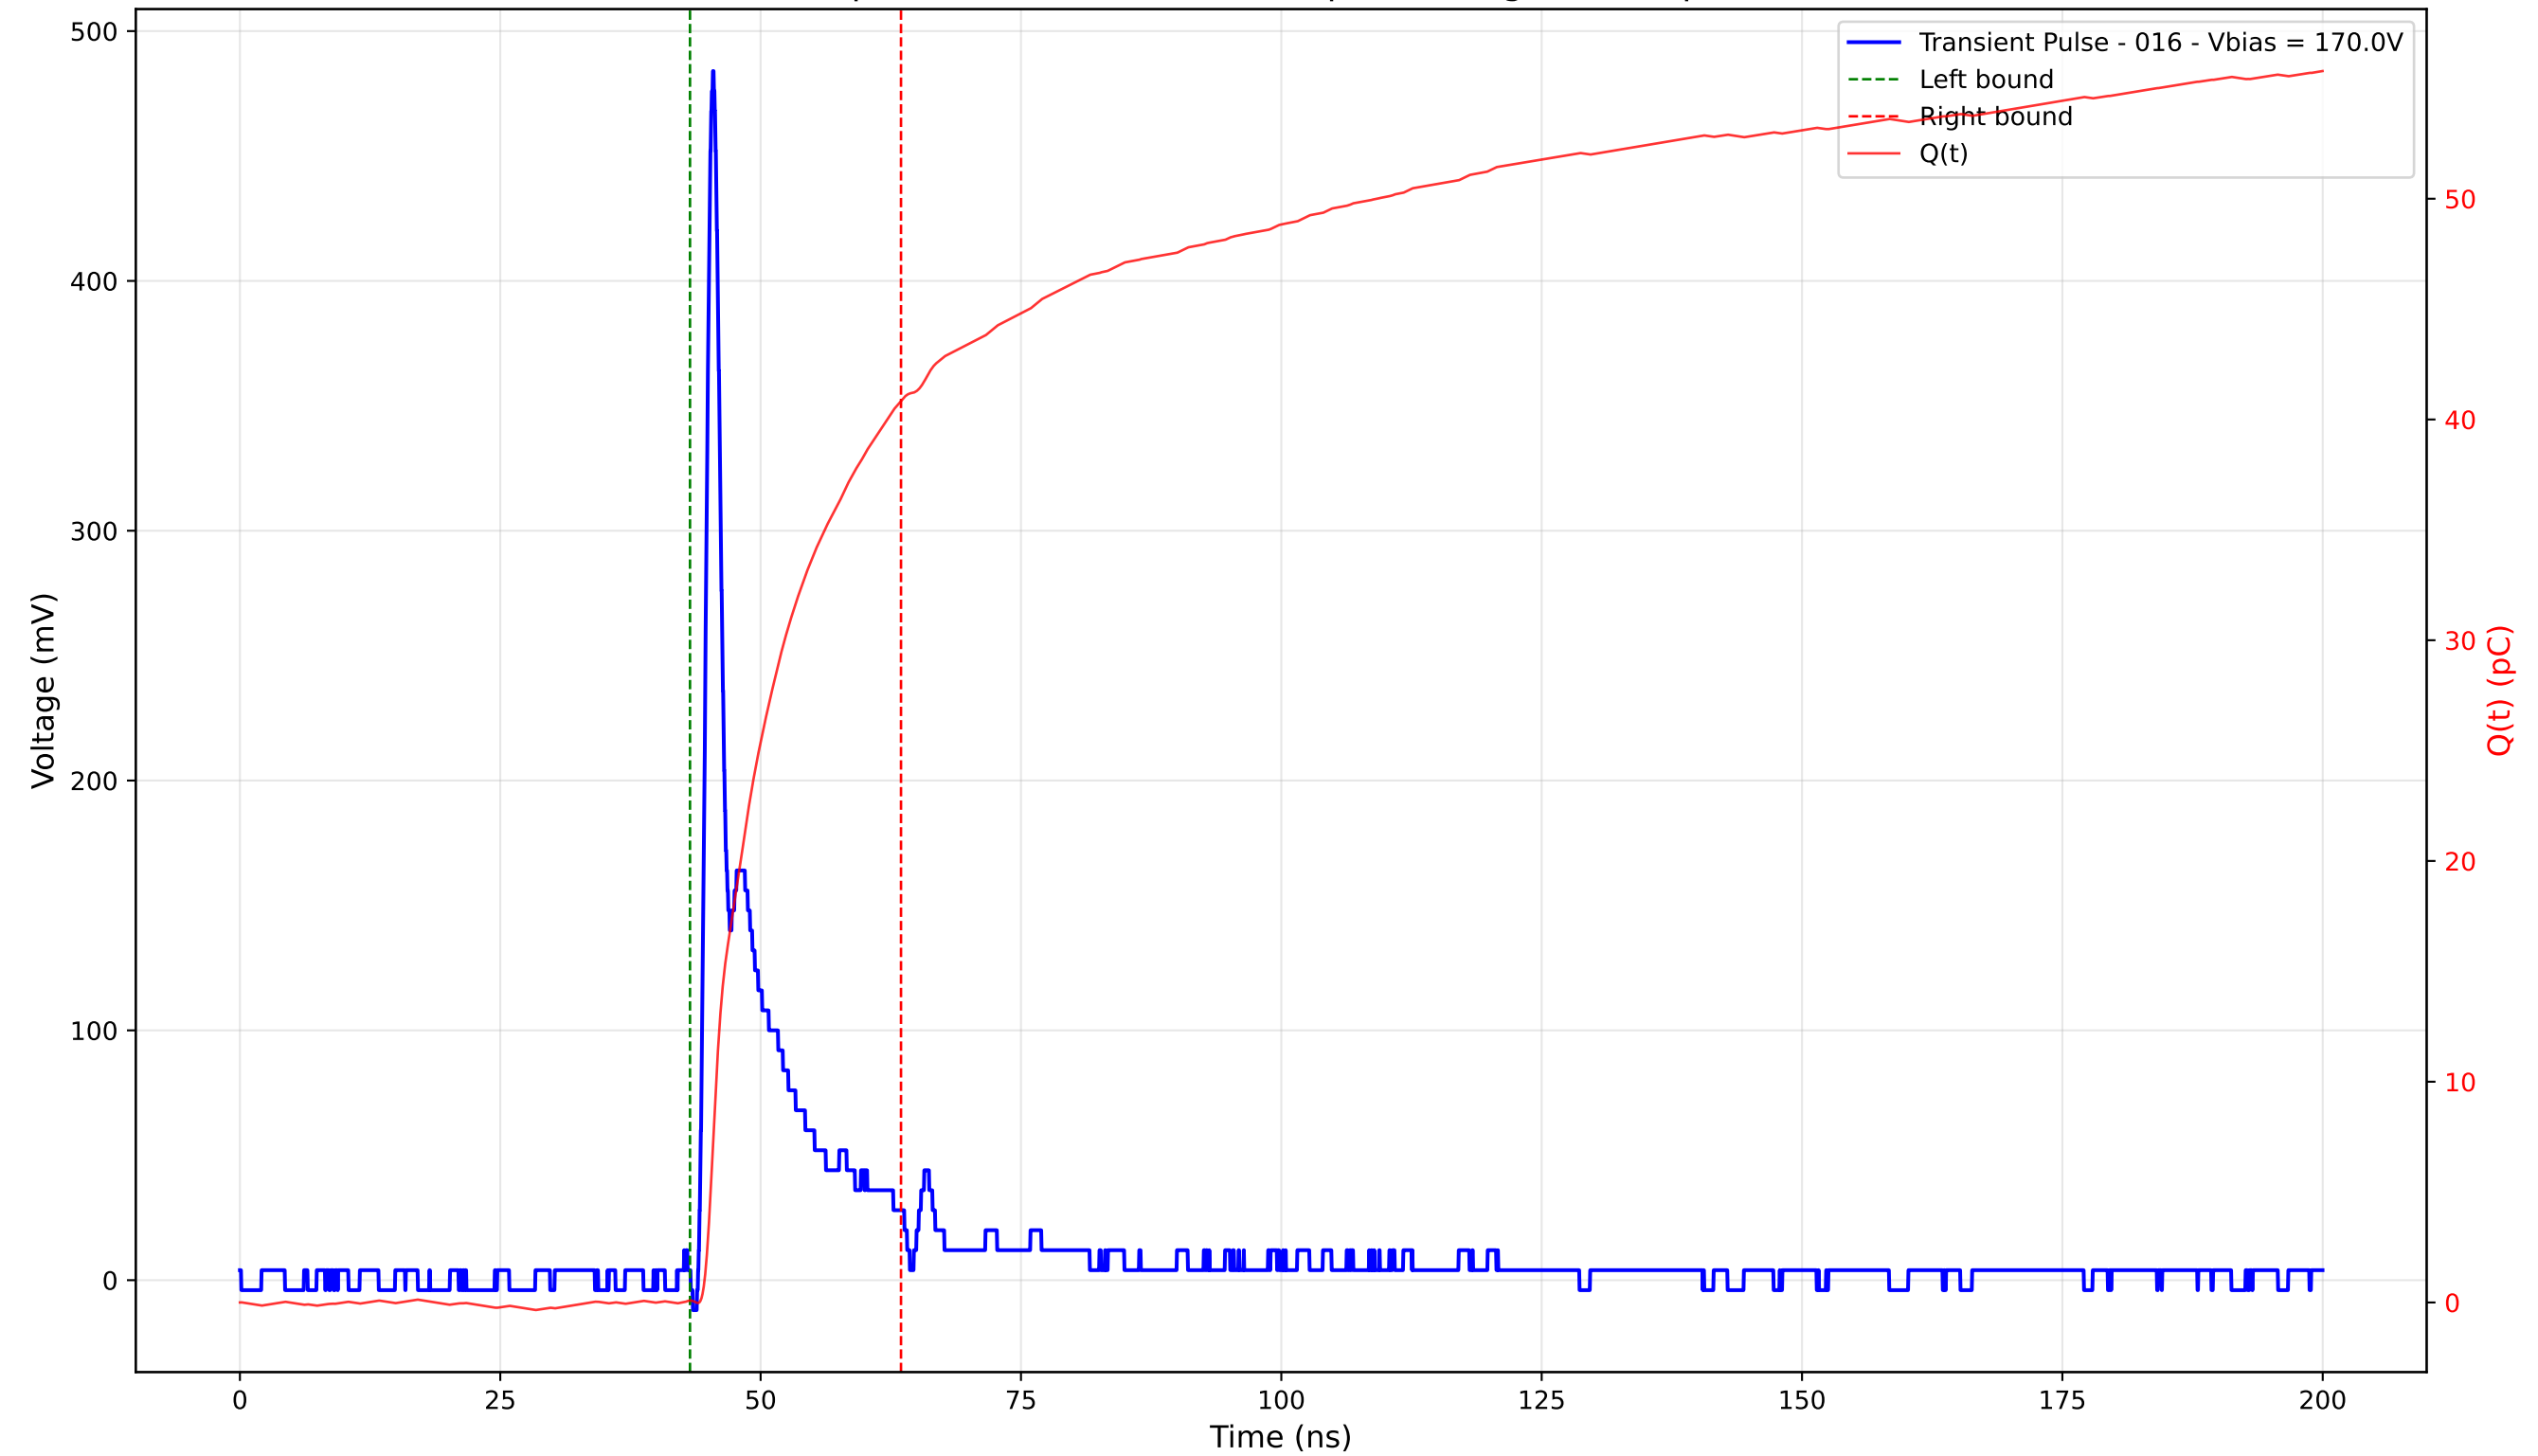


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 40.83 pC - Rise Time: 0.92 ns

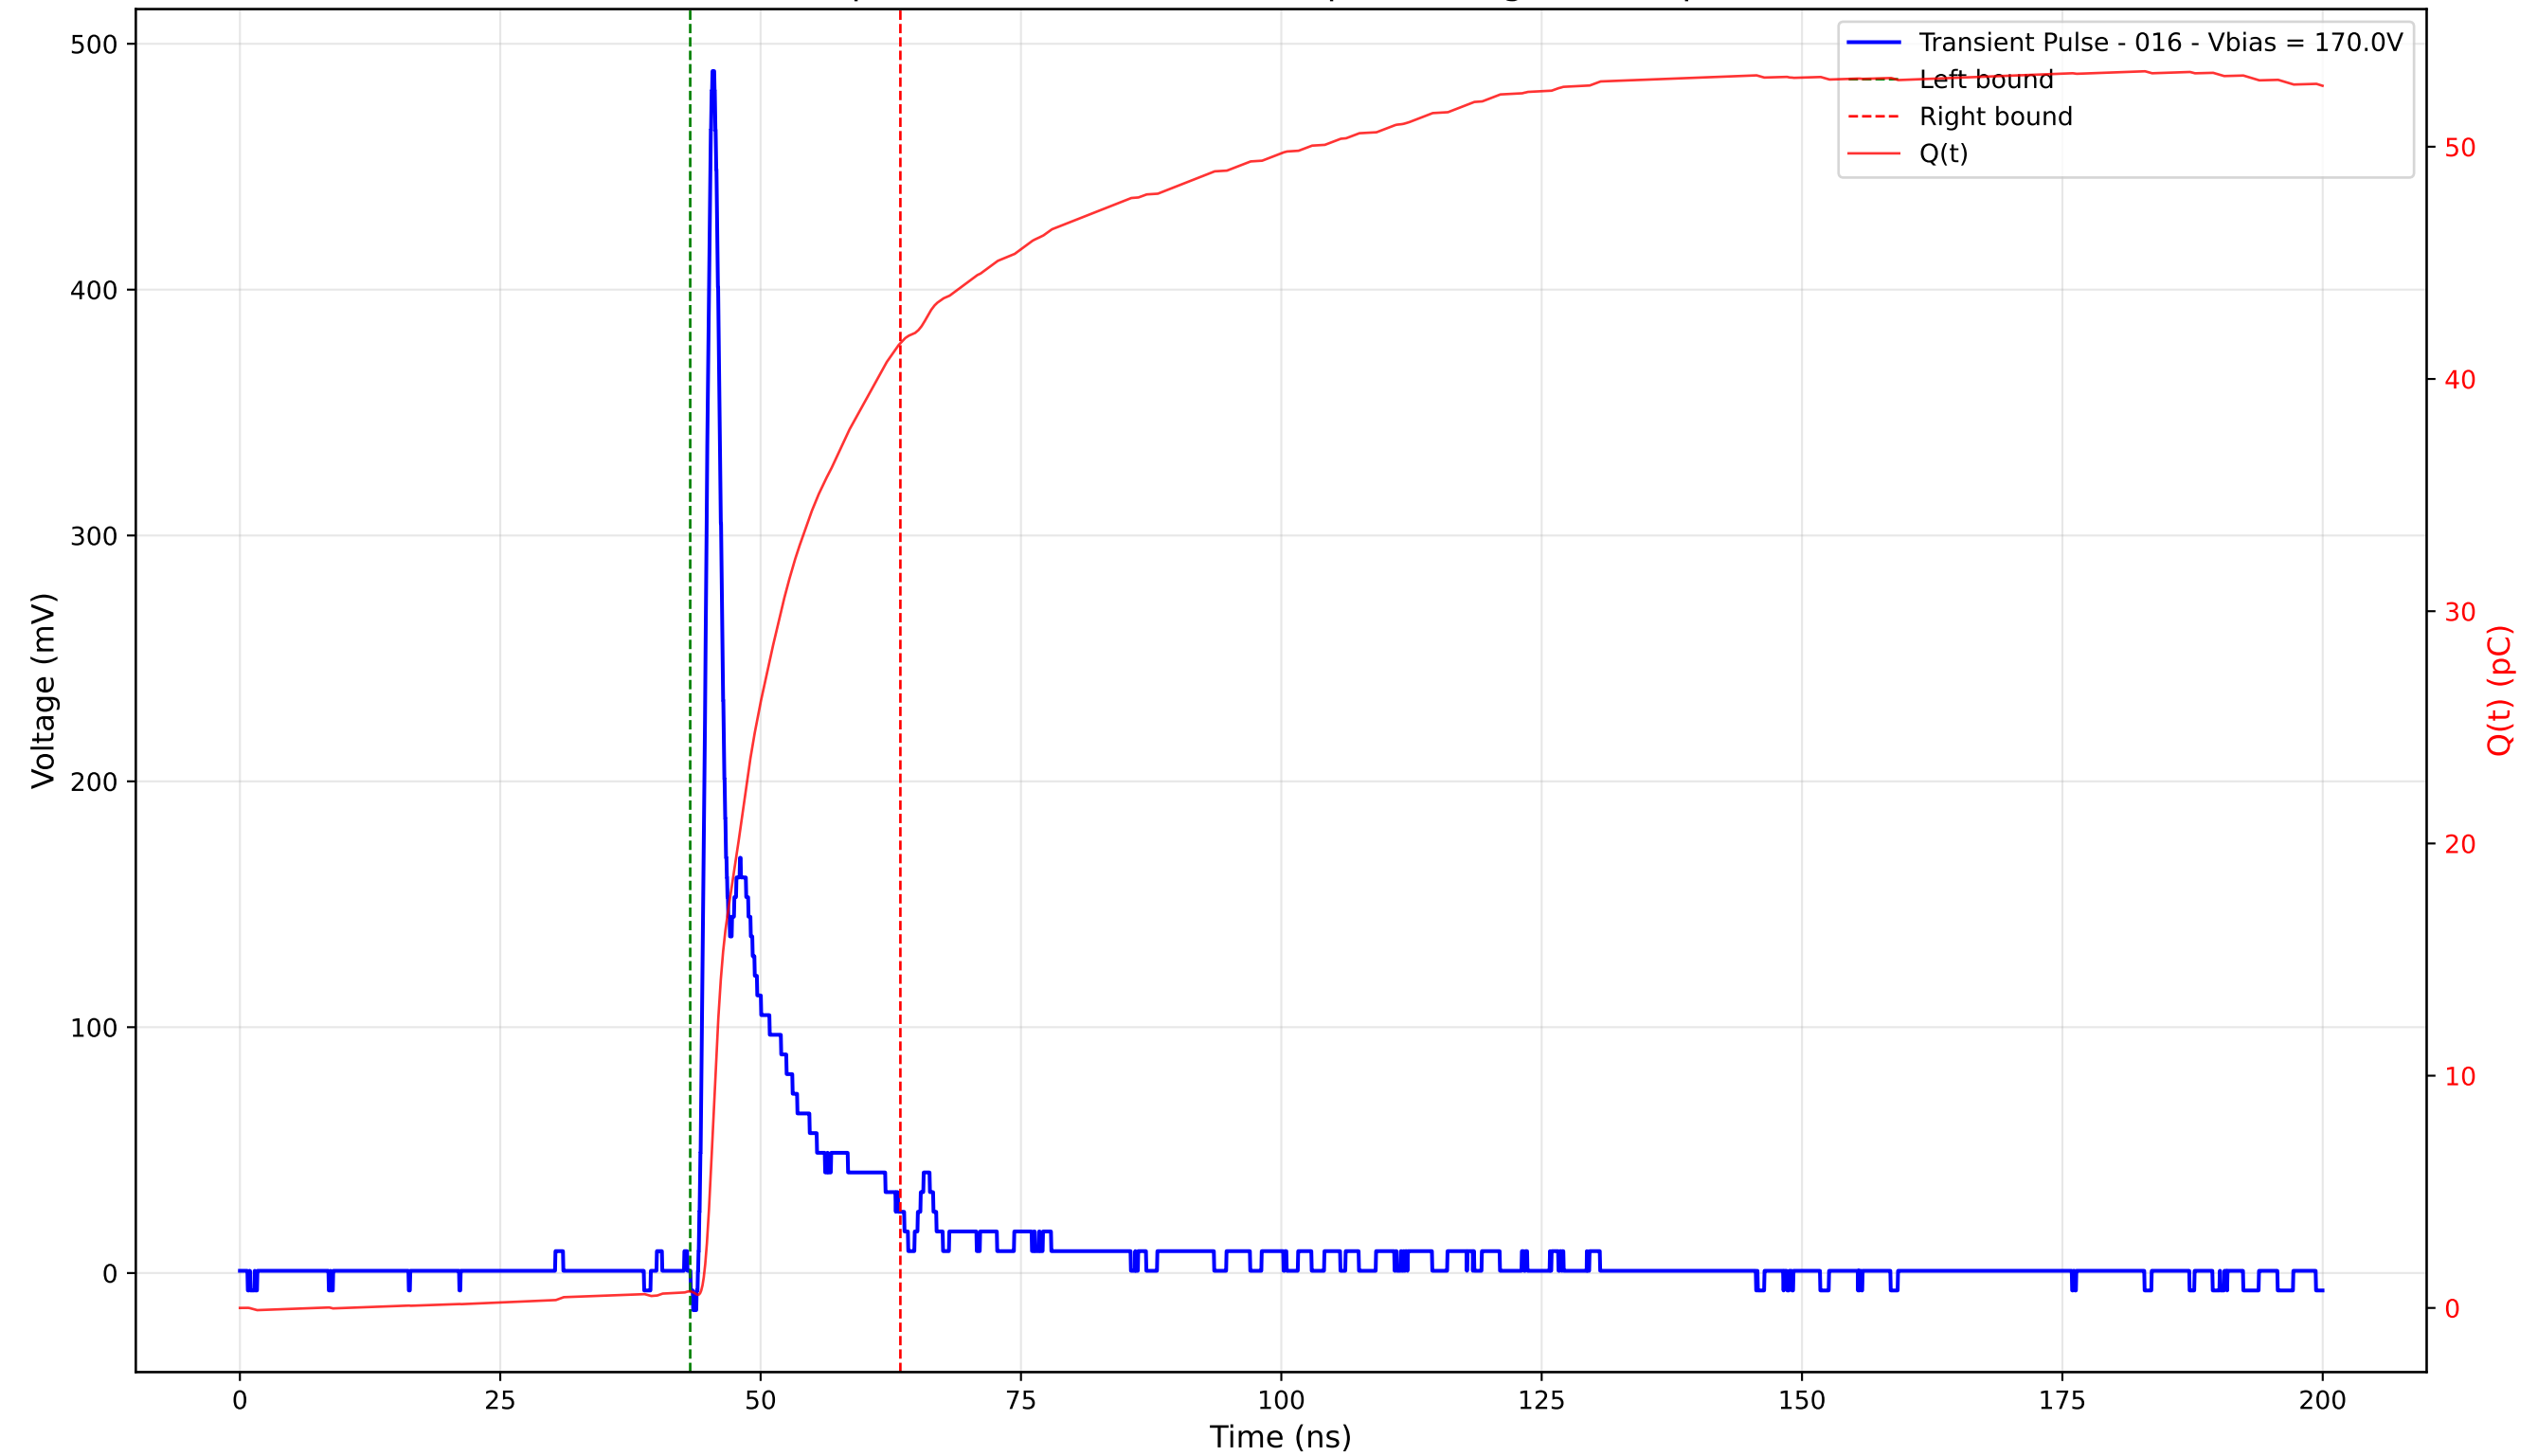


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 41.38 pC - Rise Time: 0.90 ns

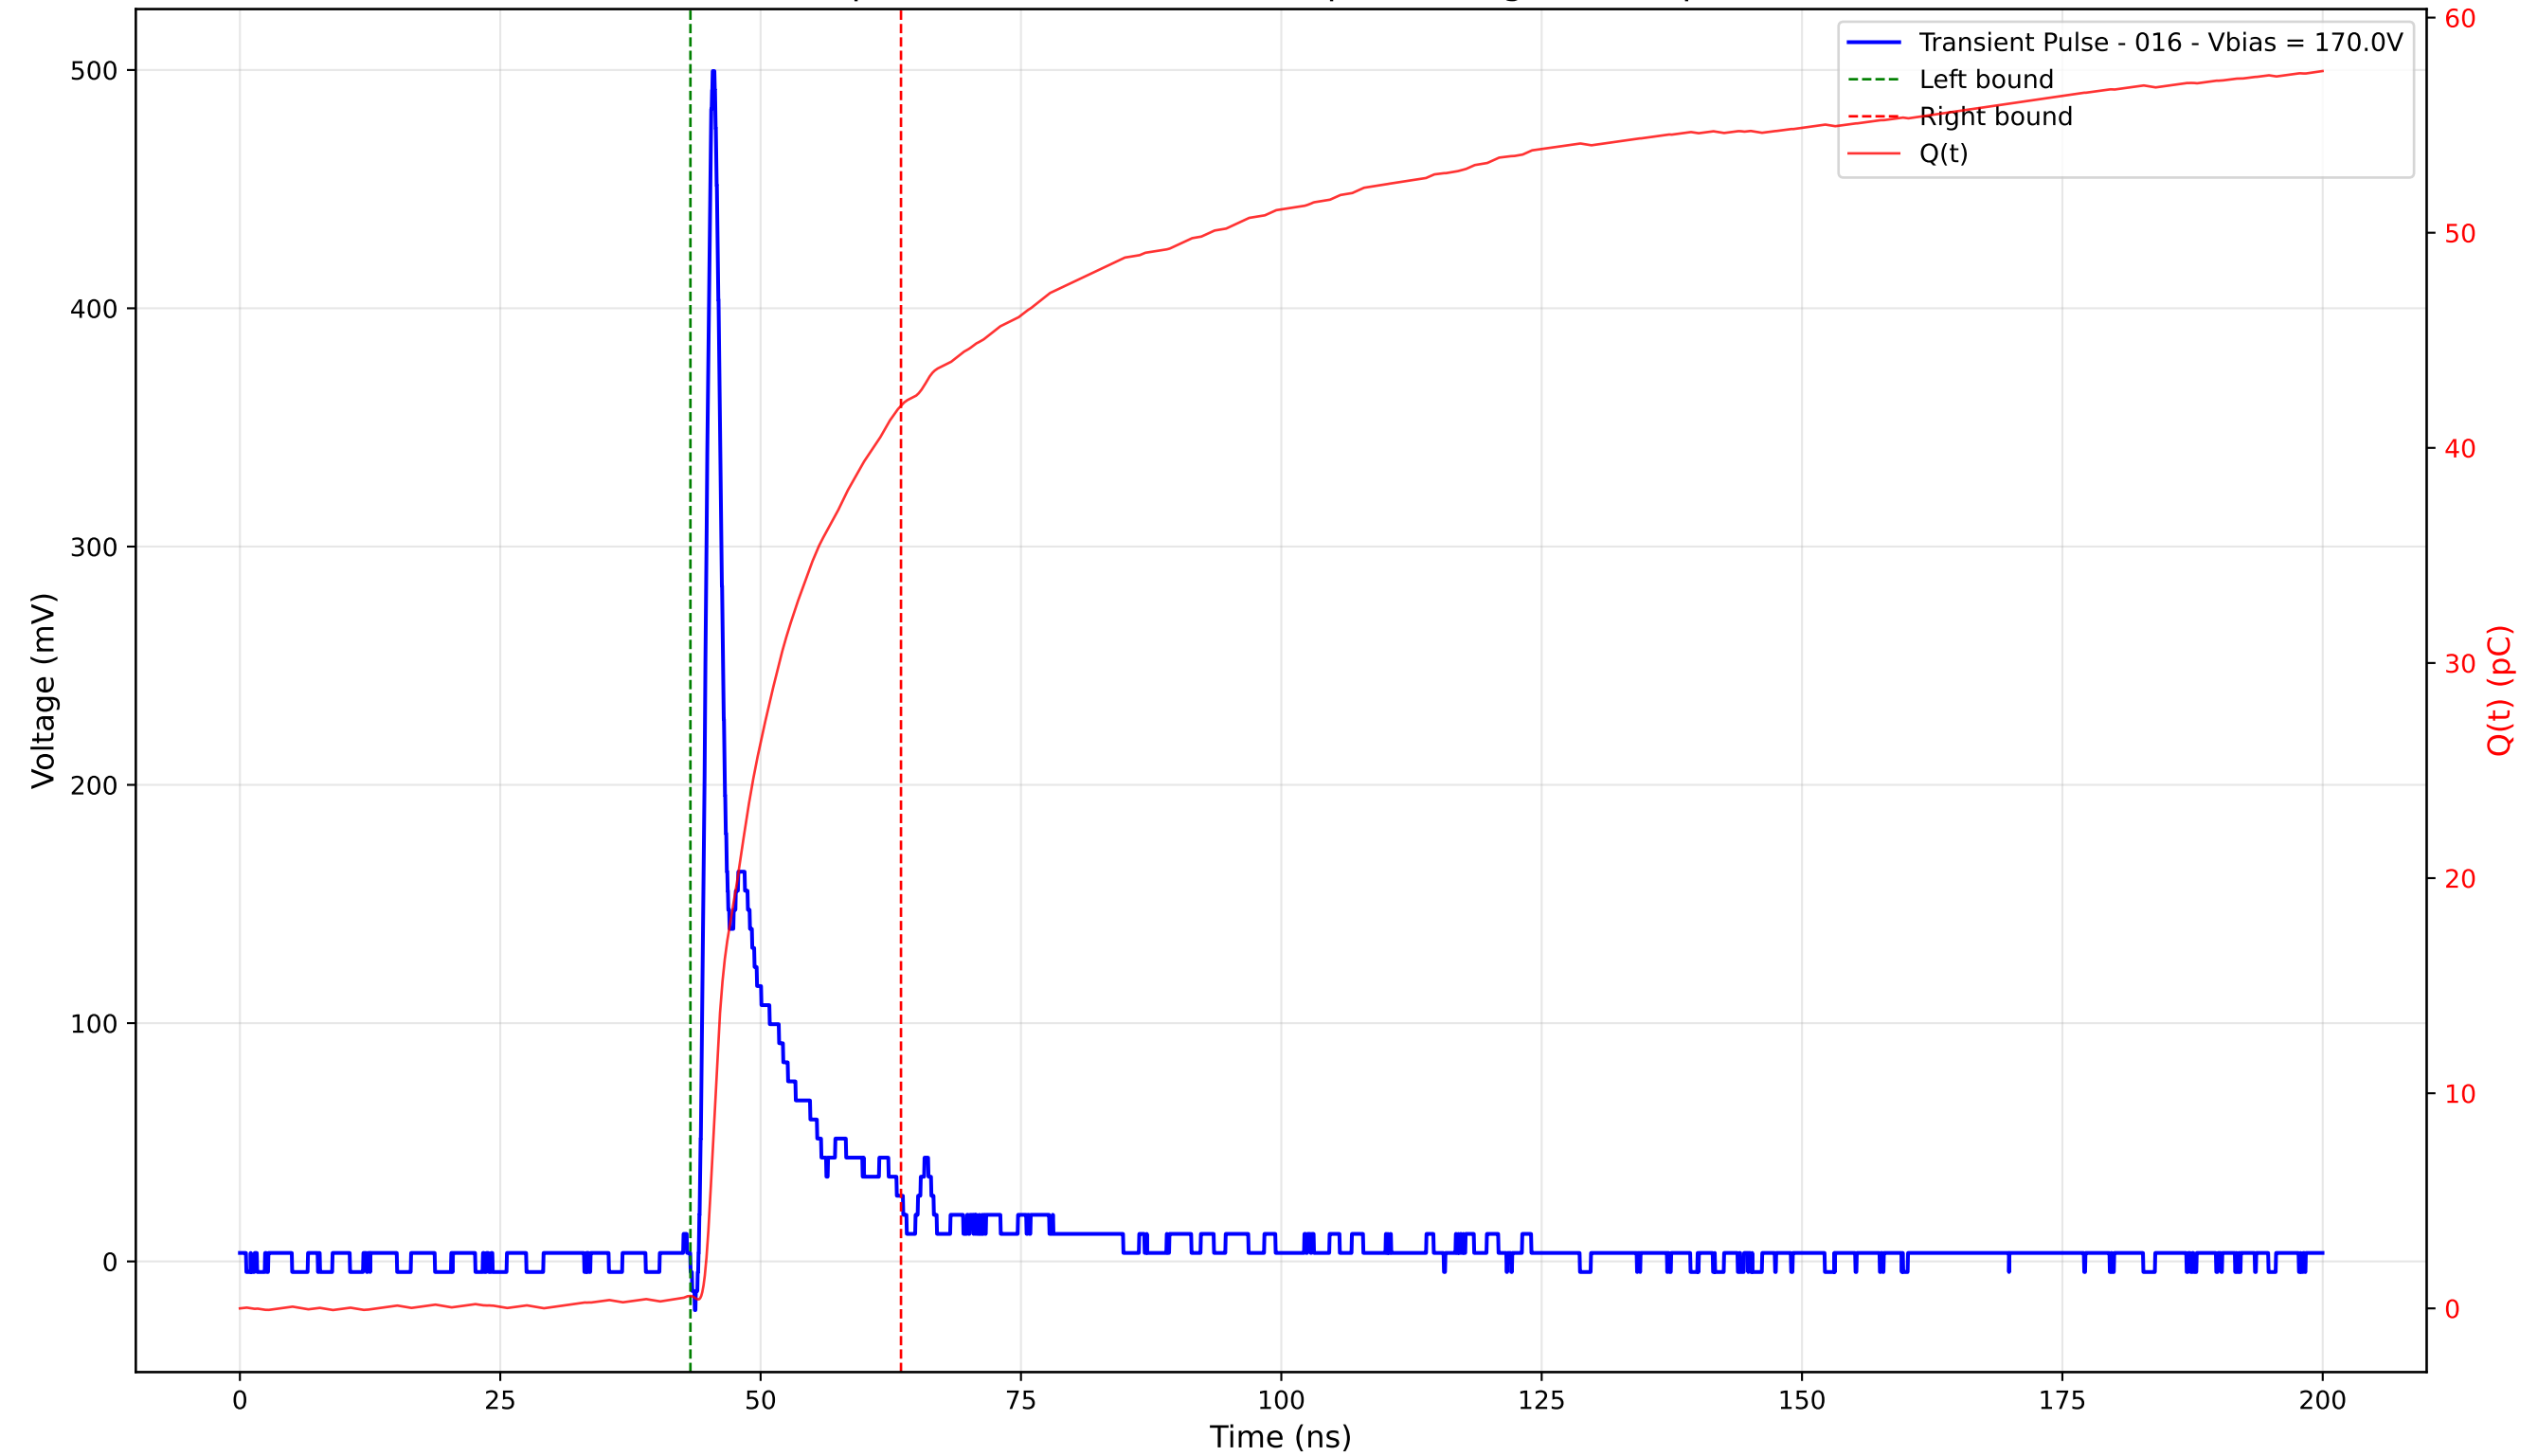


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 40.74 pC - Rise Time: 0.93 ns

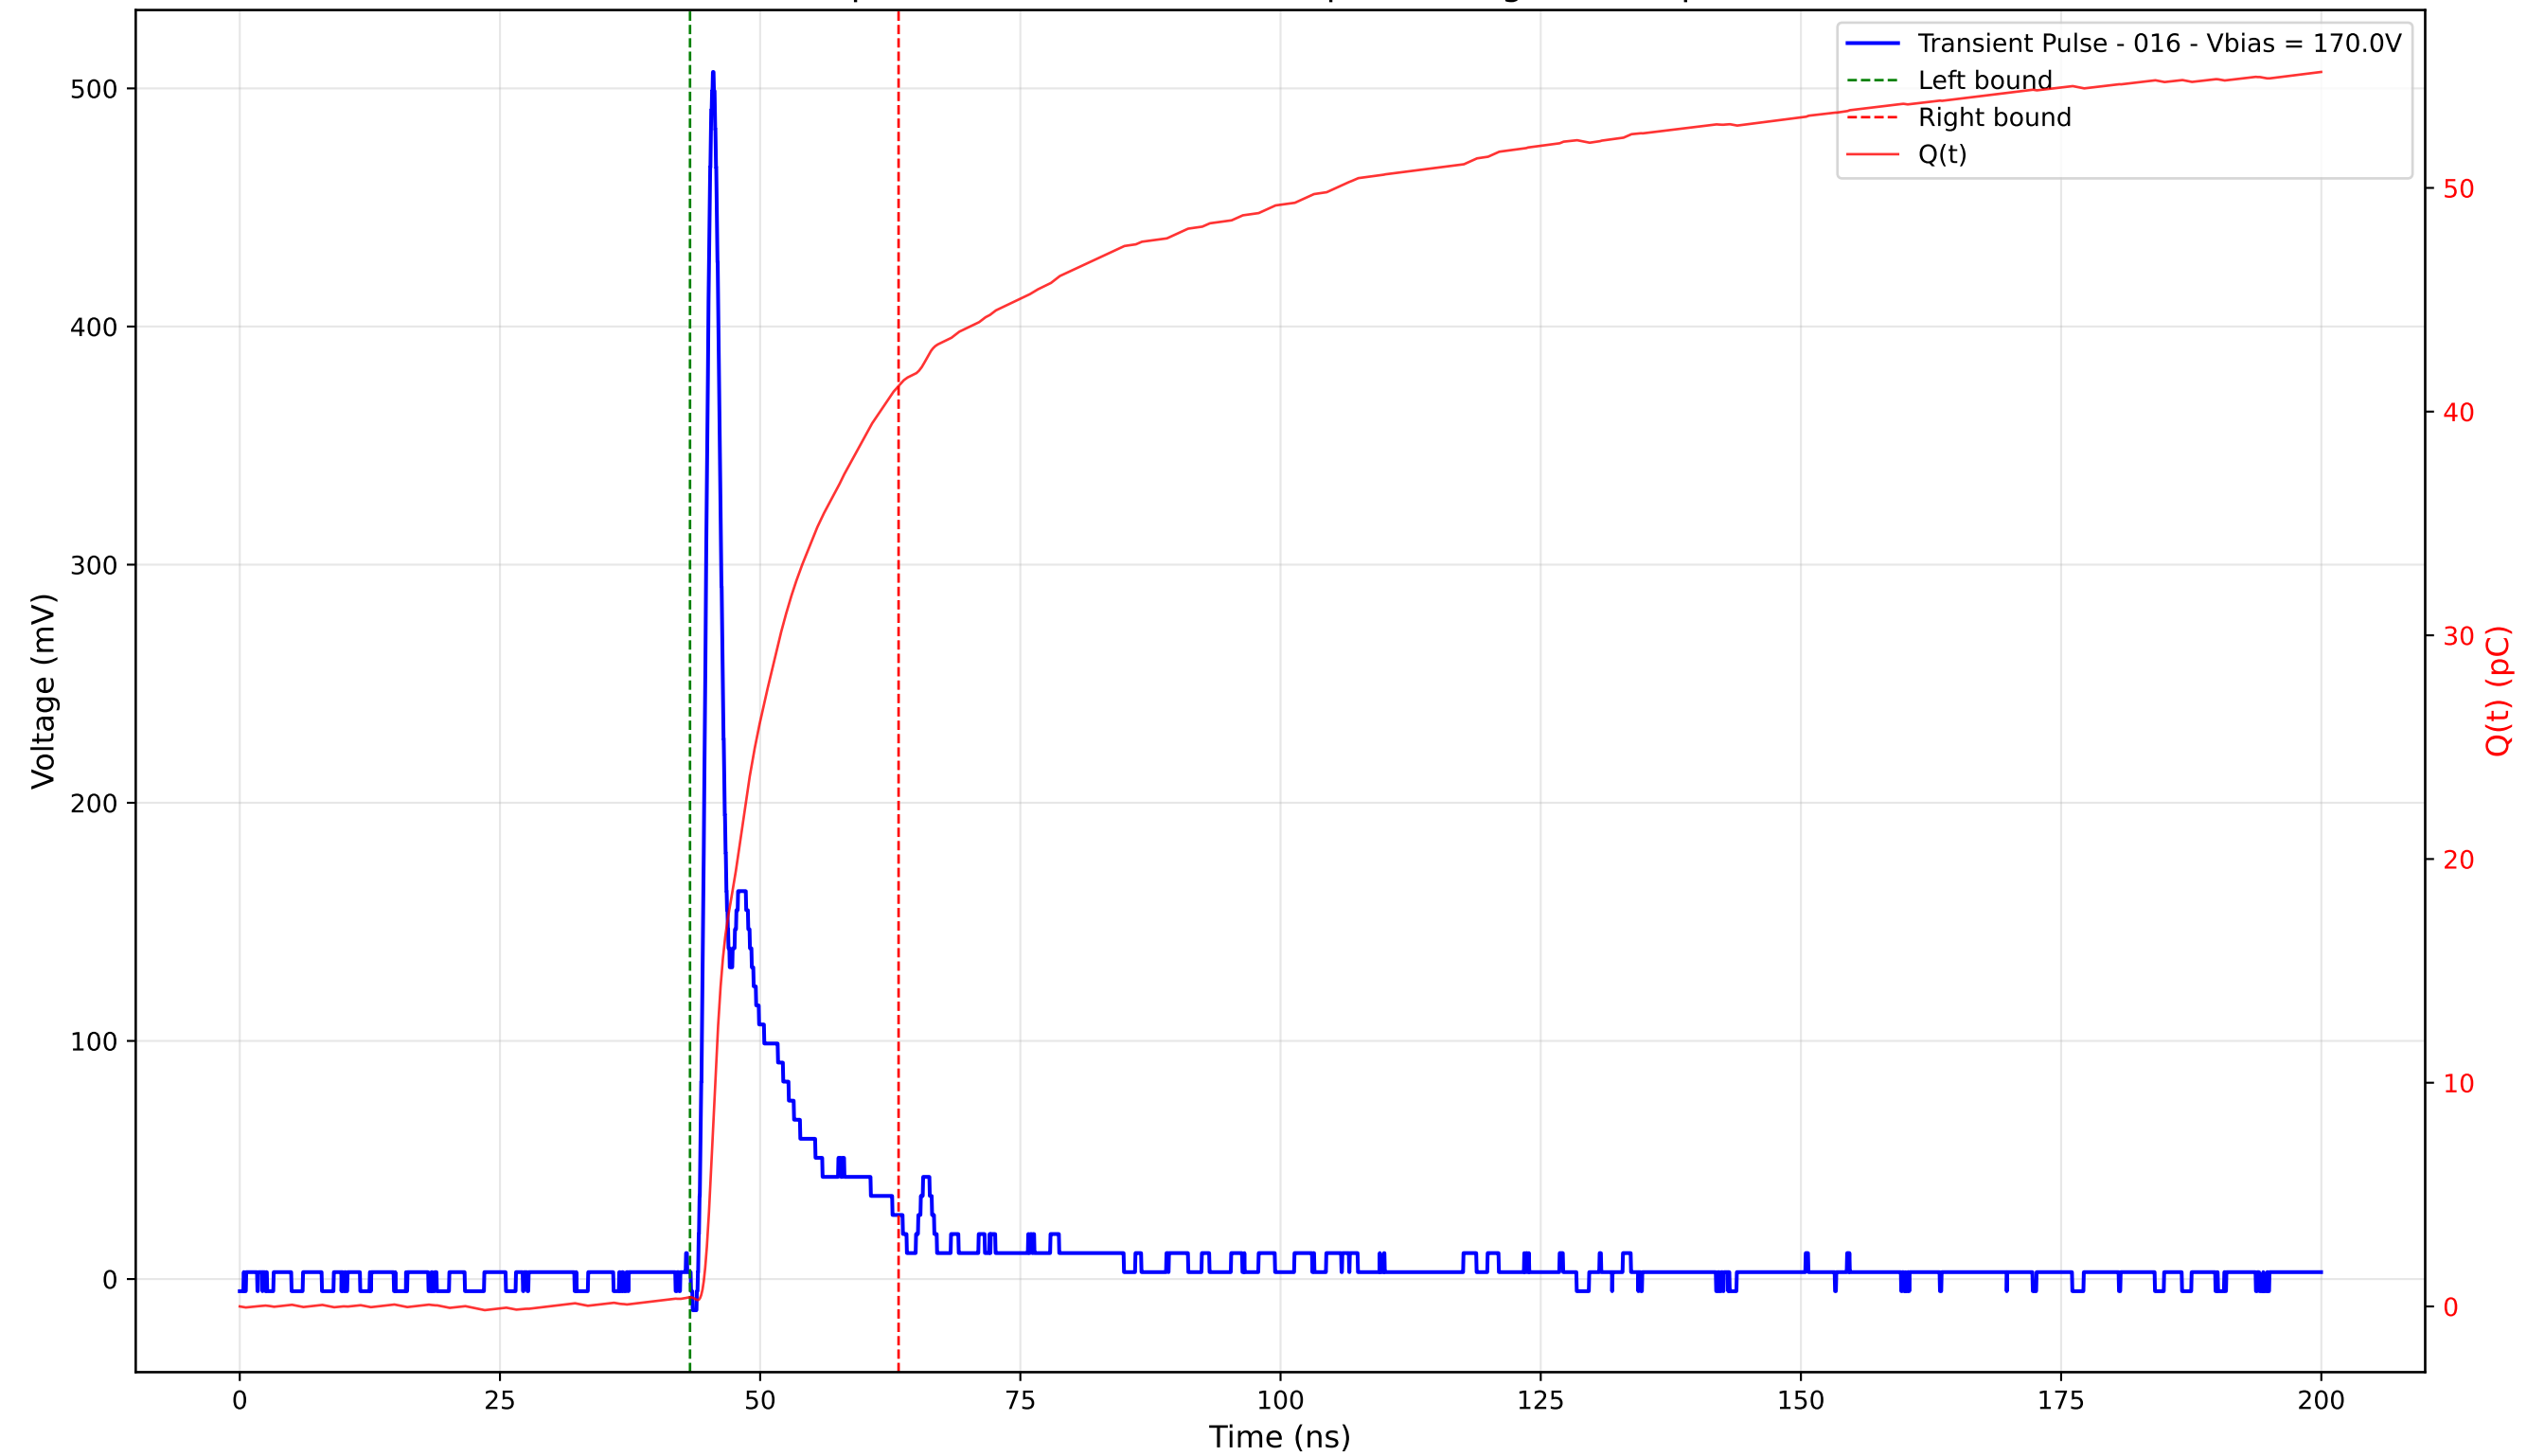


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 40.73 pC - Rise Time: 0.93 ns

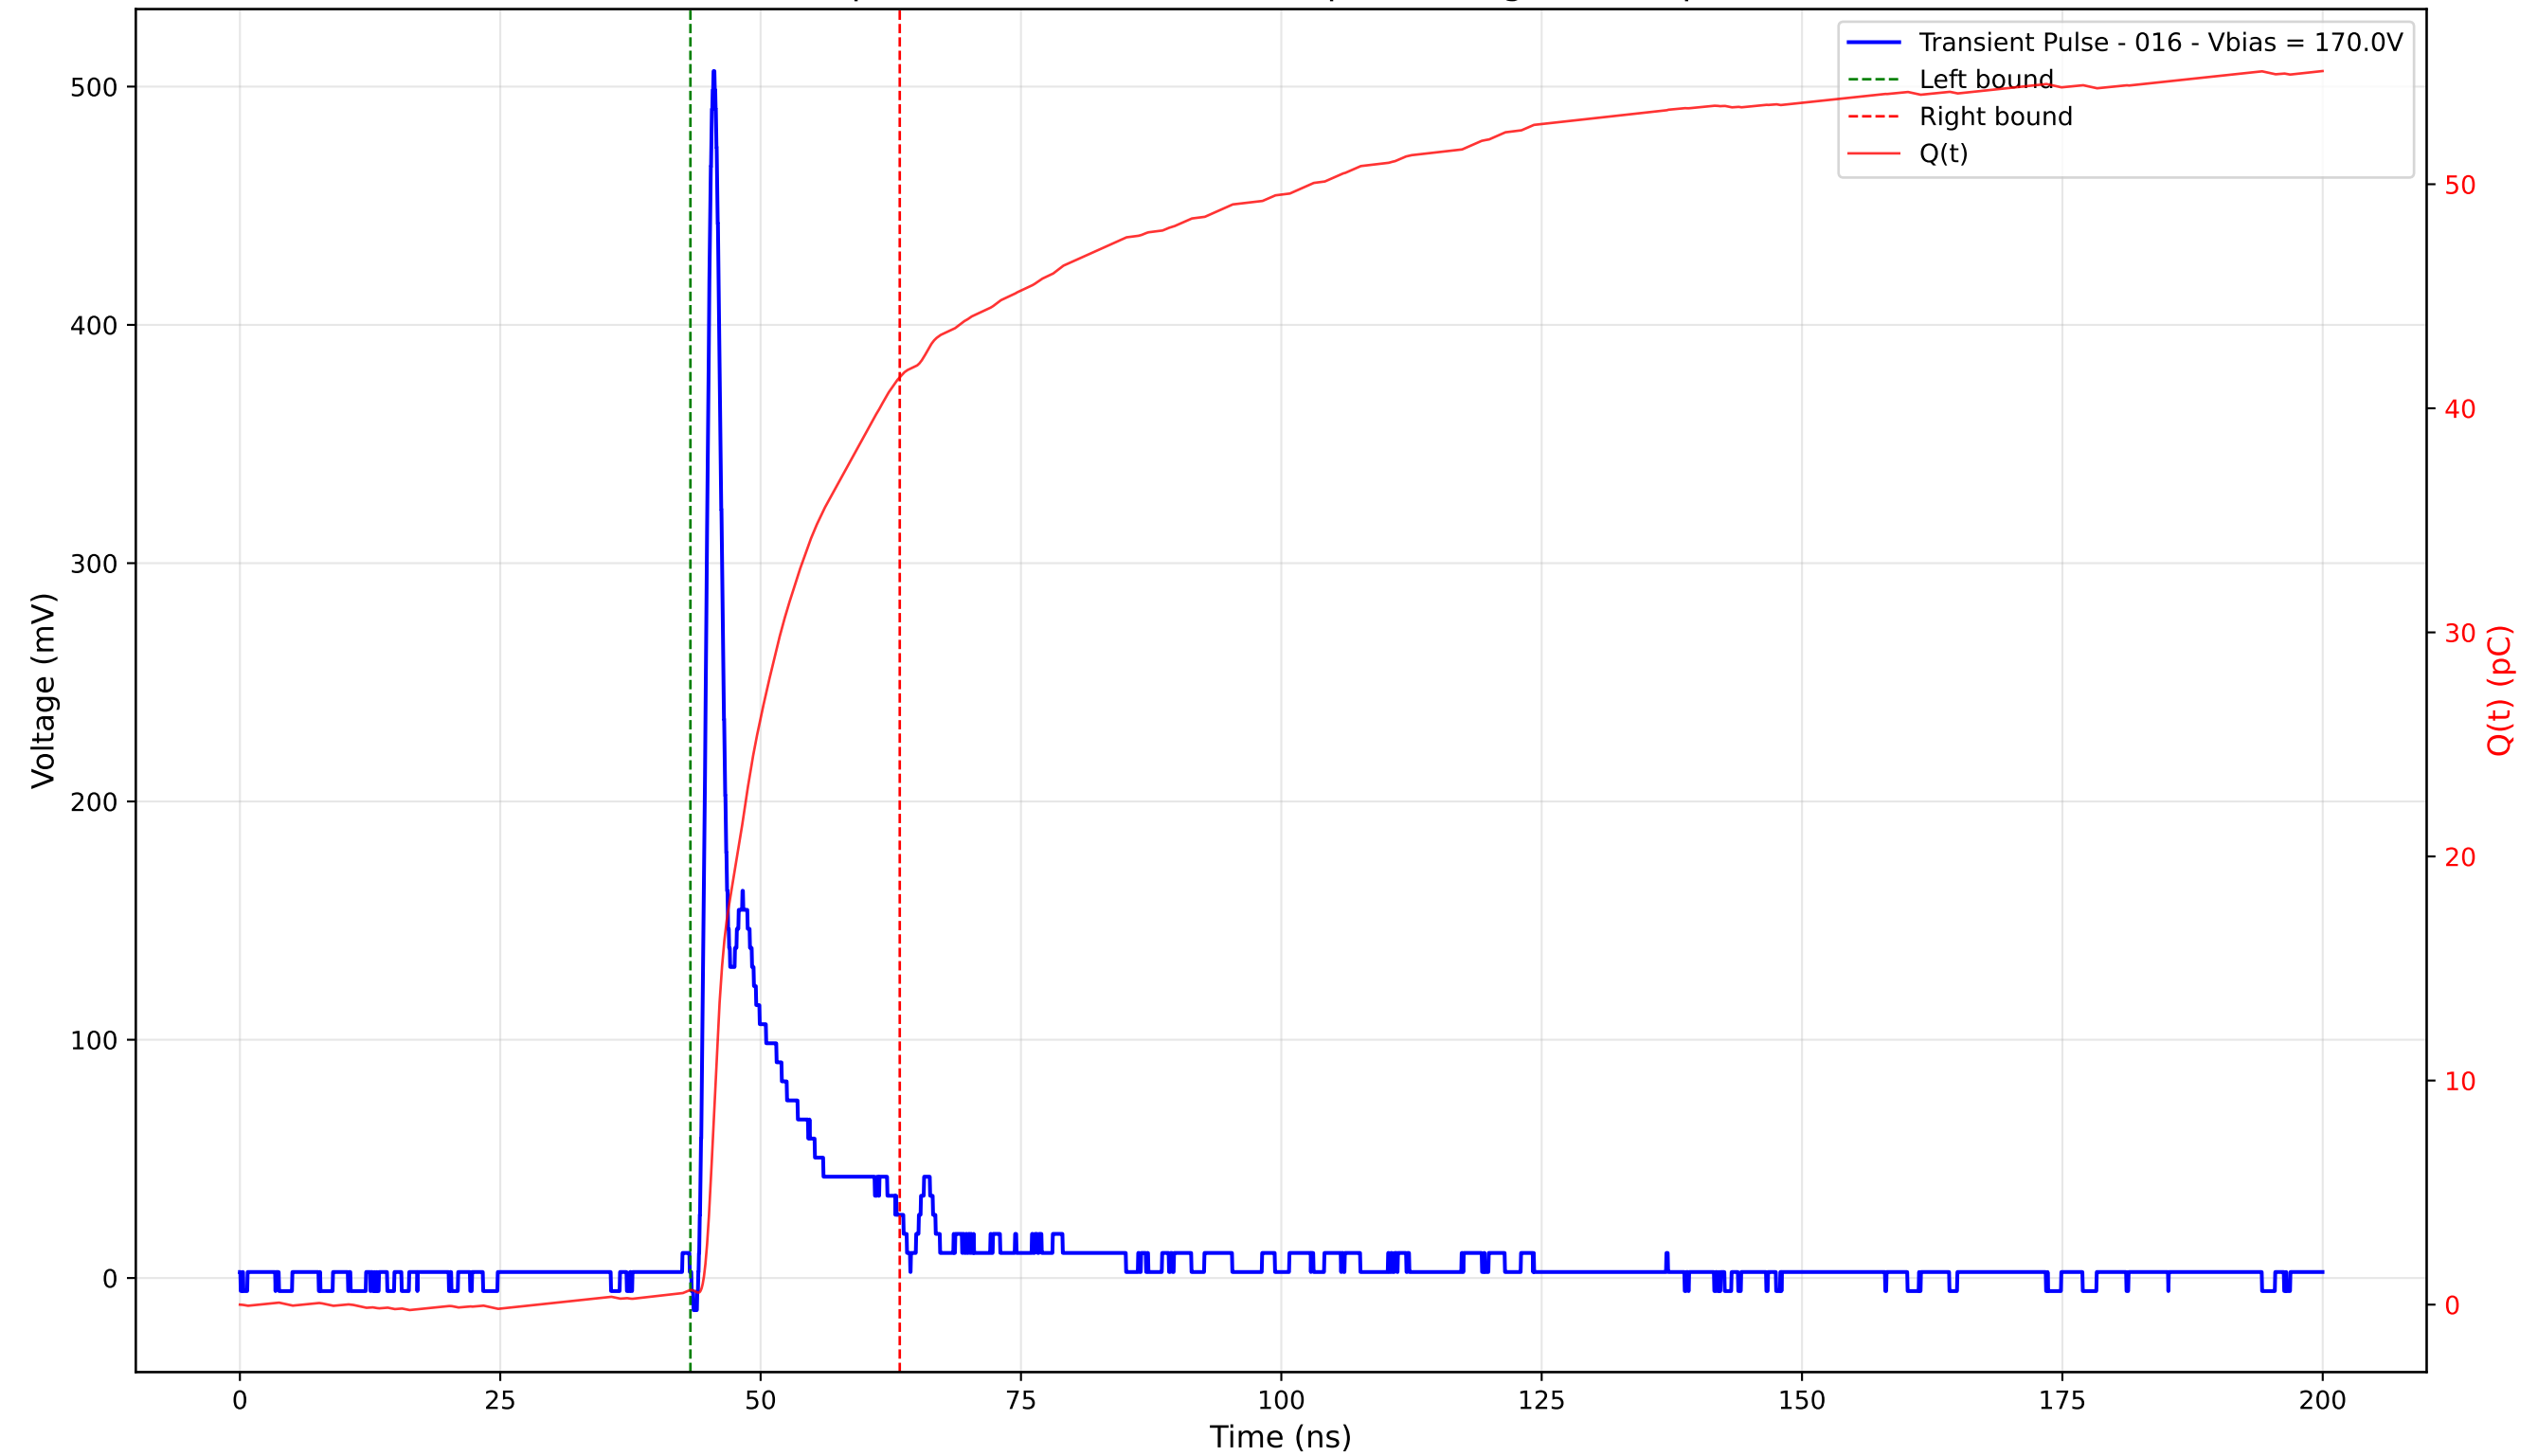


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 39.73 pC - Rise Time: 0.93 ns

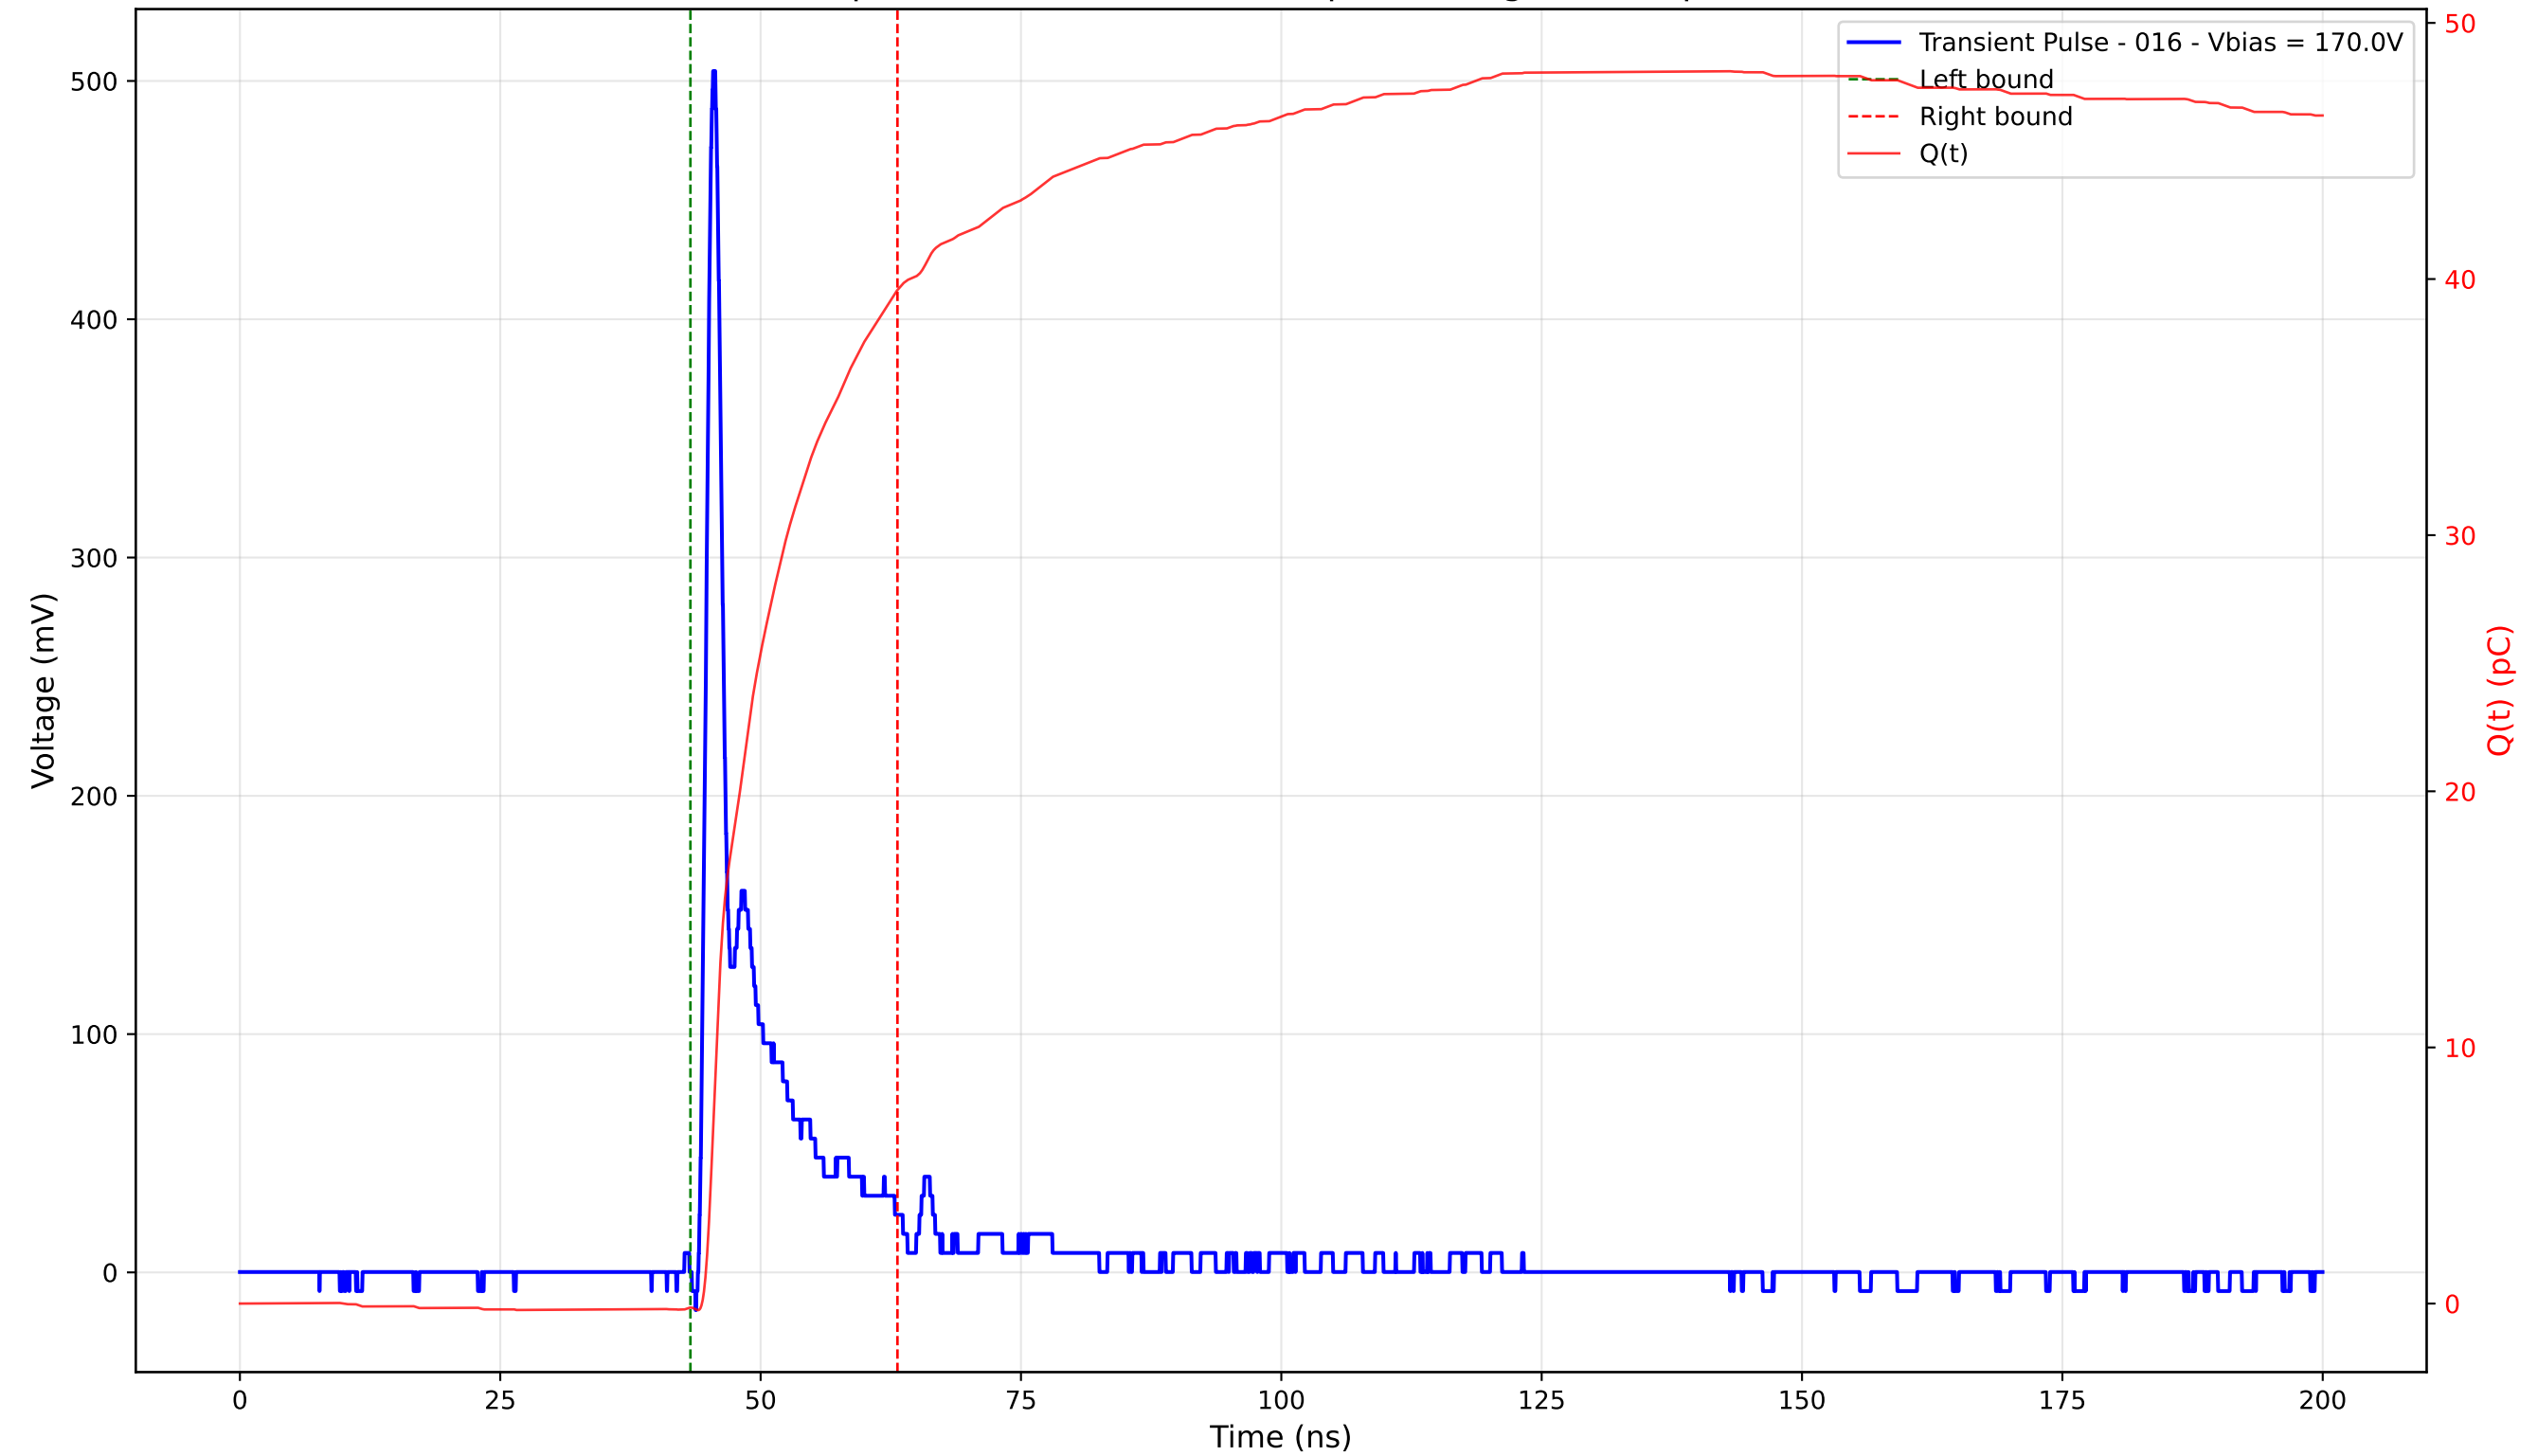


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 41.84 pC - Rise Time: 0.96 ns

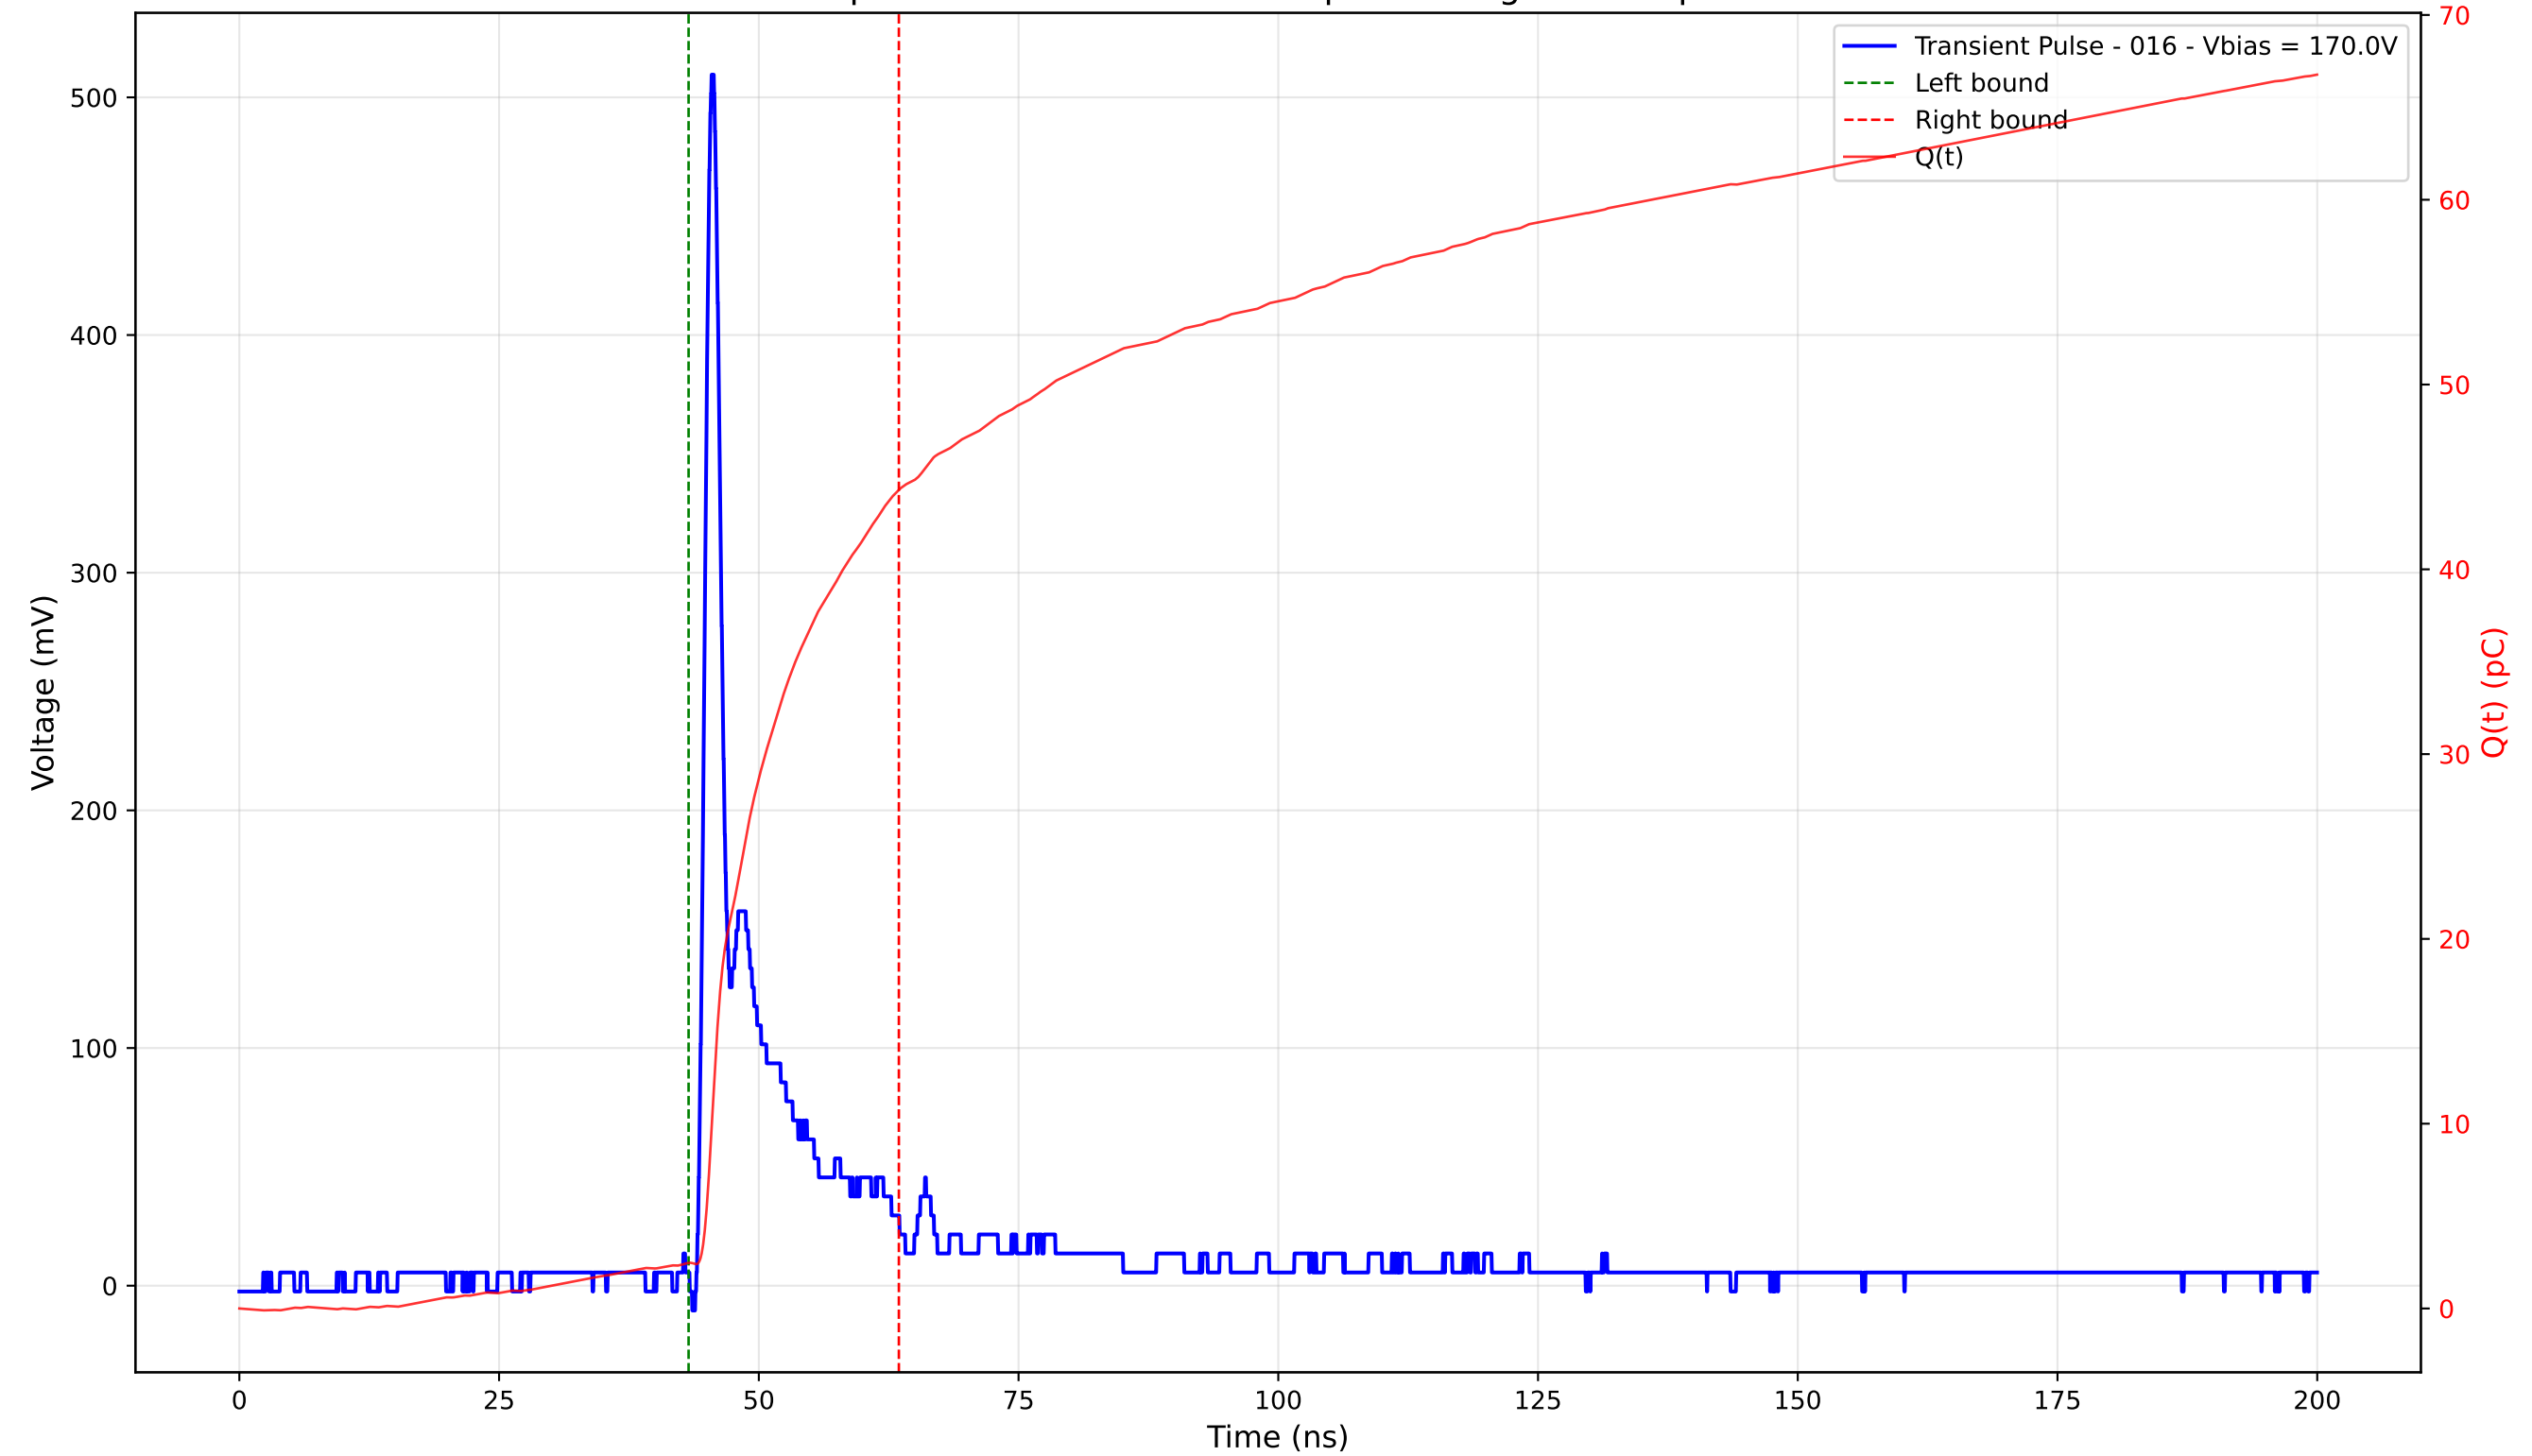


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 39.96 pC - Rise Time: 0.97 ns

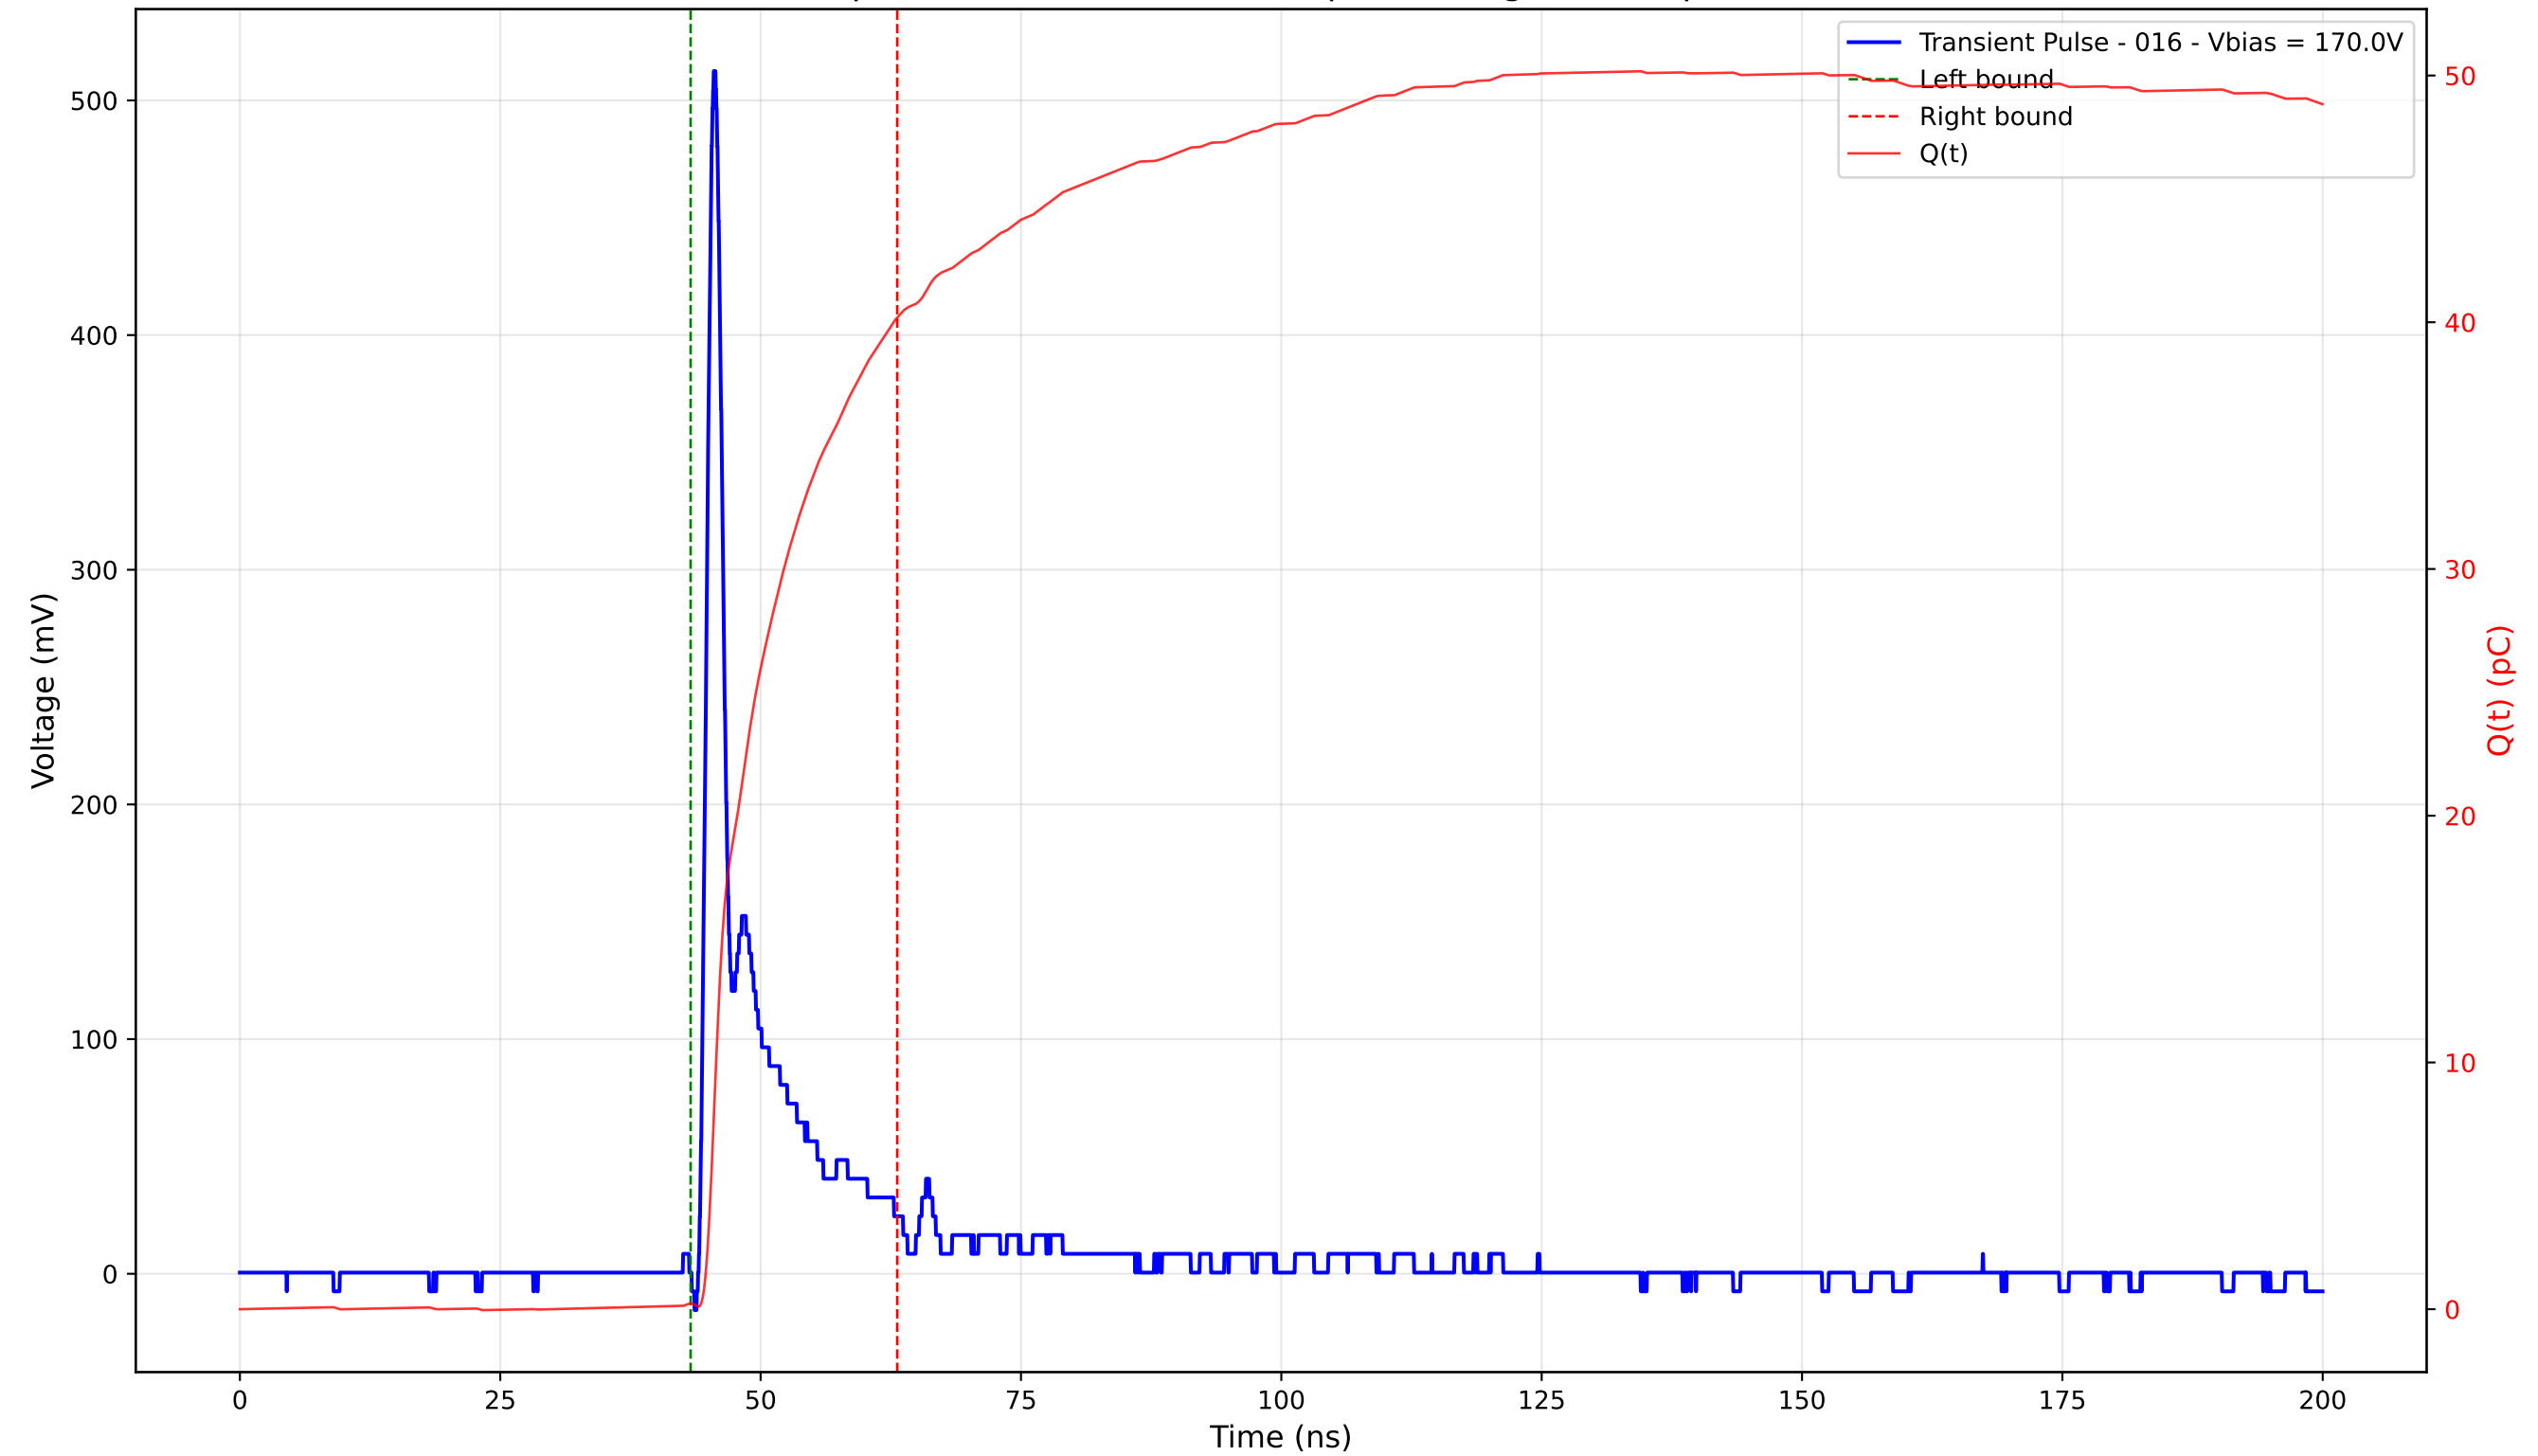


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 39.20 pC - Rise Time: 0.97 ns

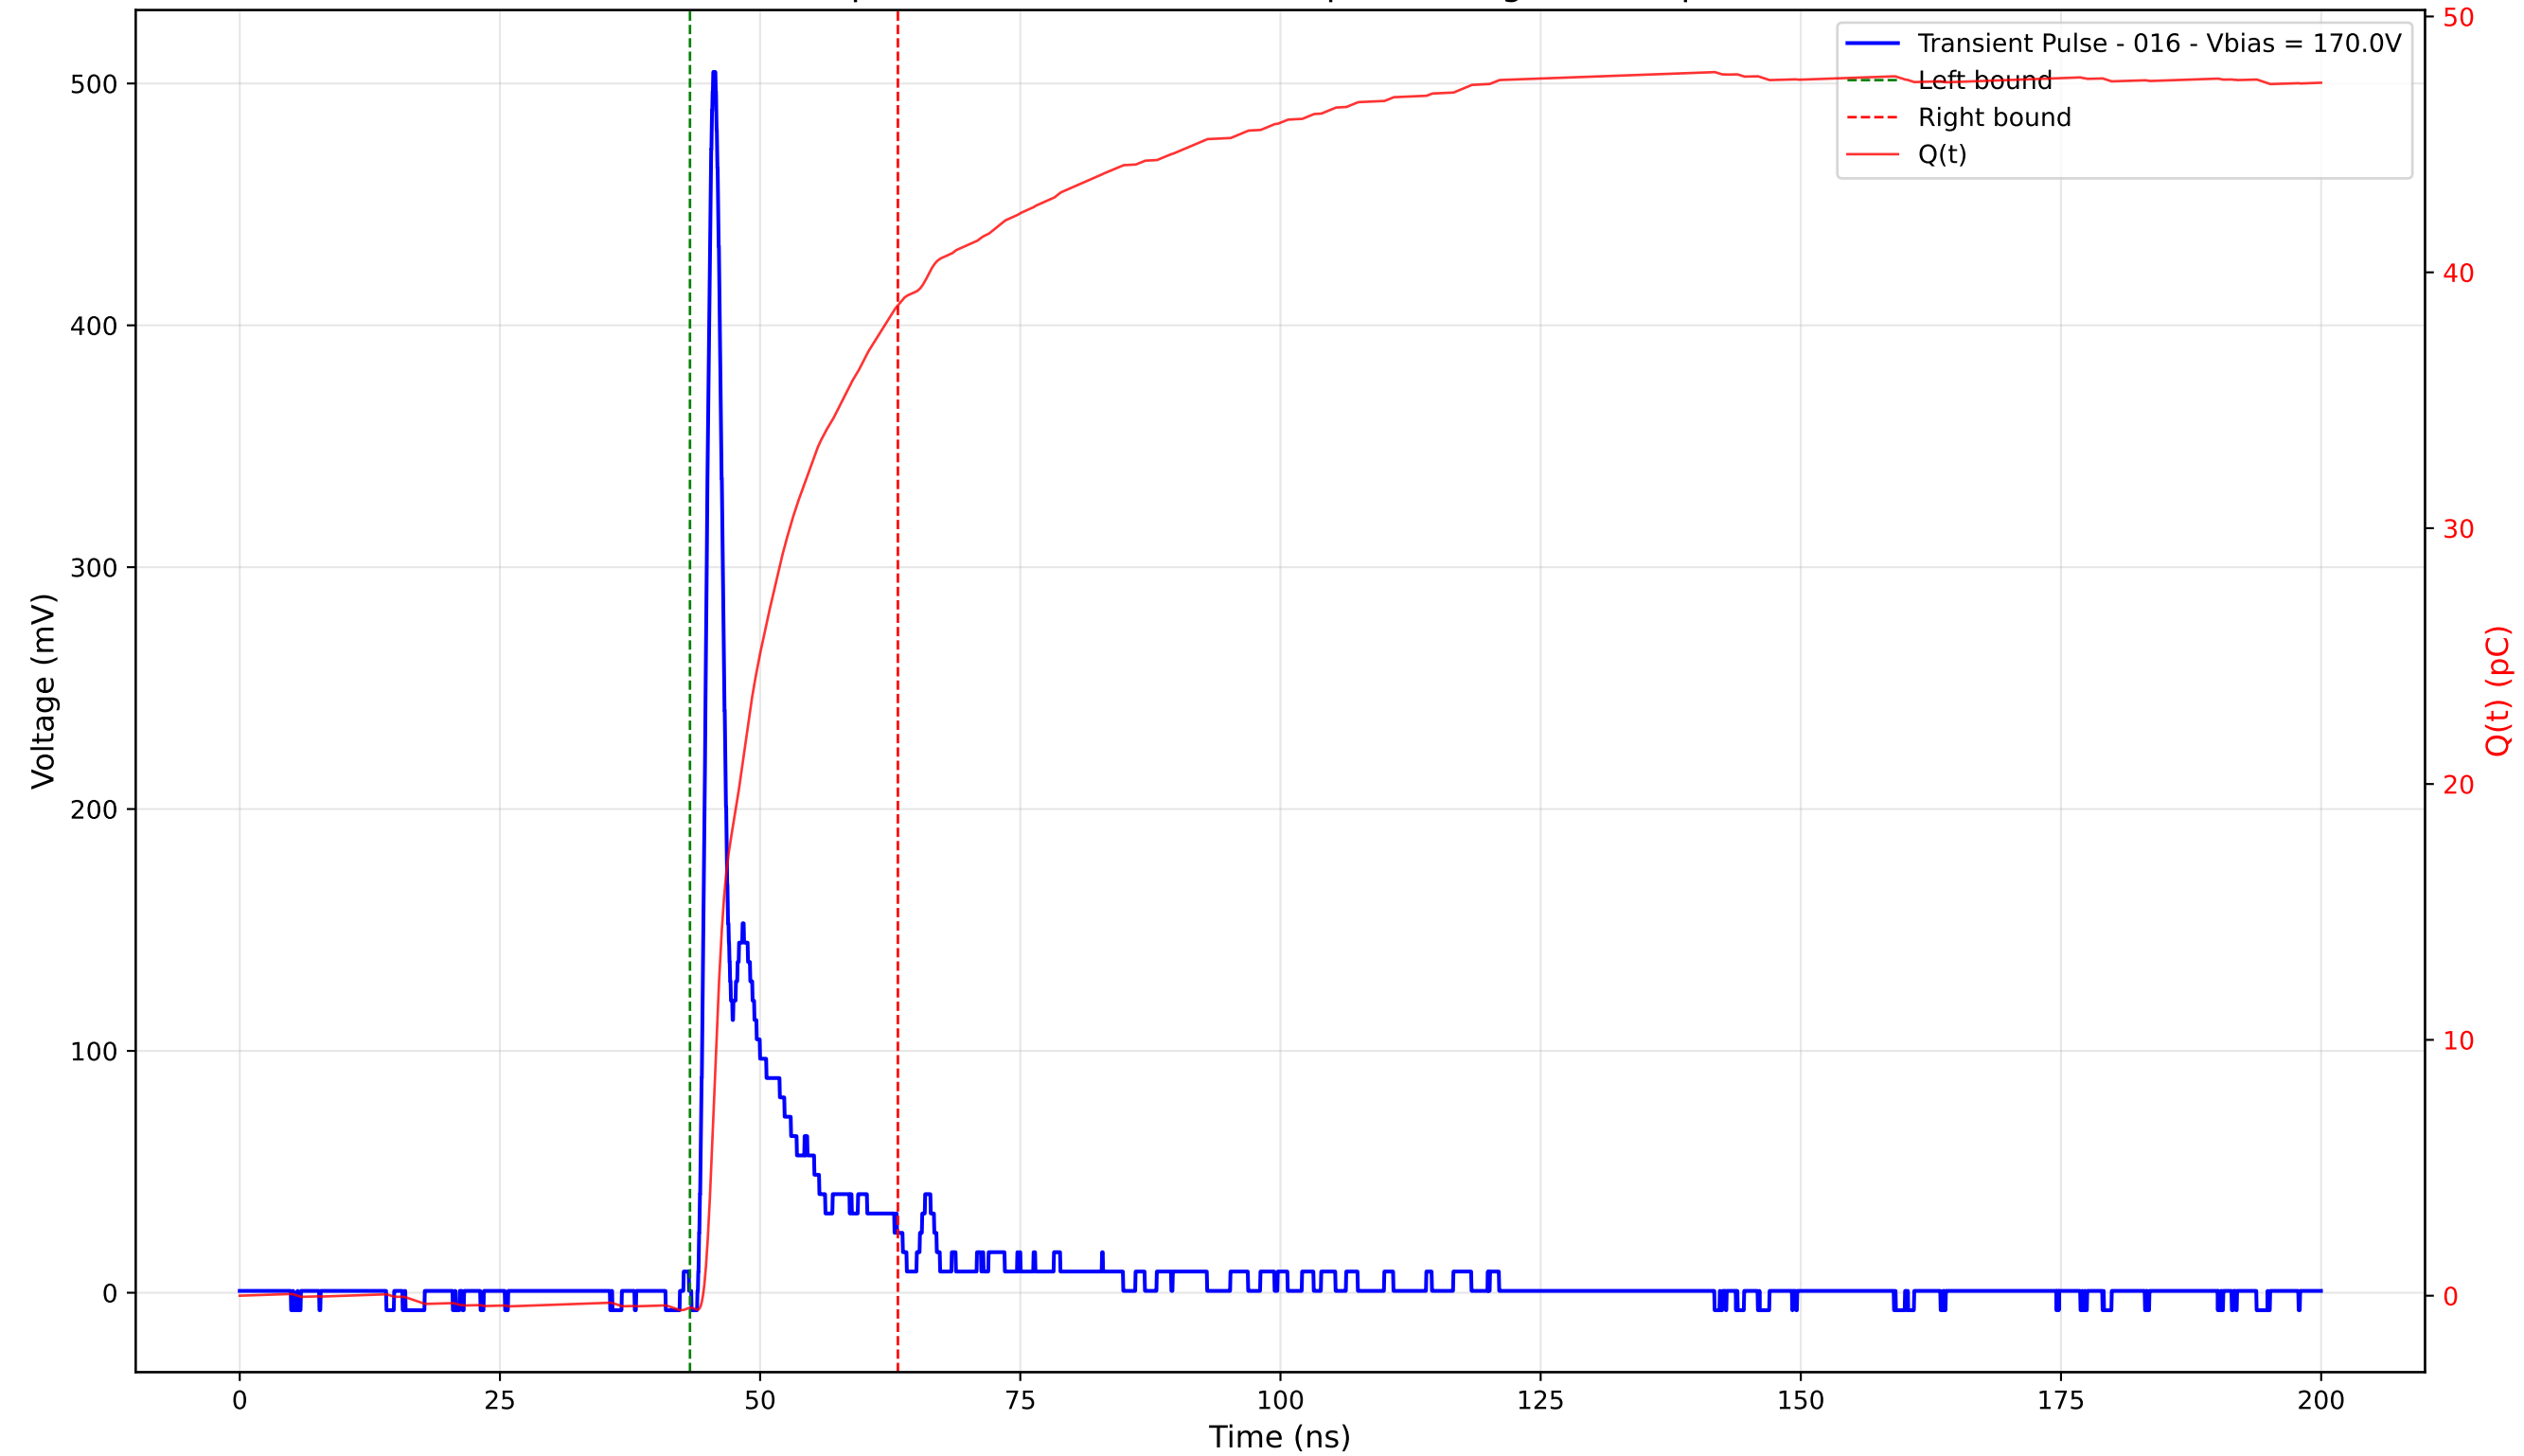


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 40.21 pC - Rise Time: 1.01 ns

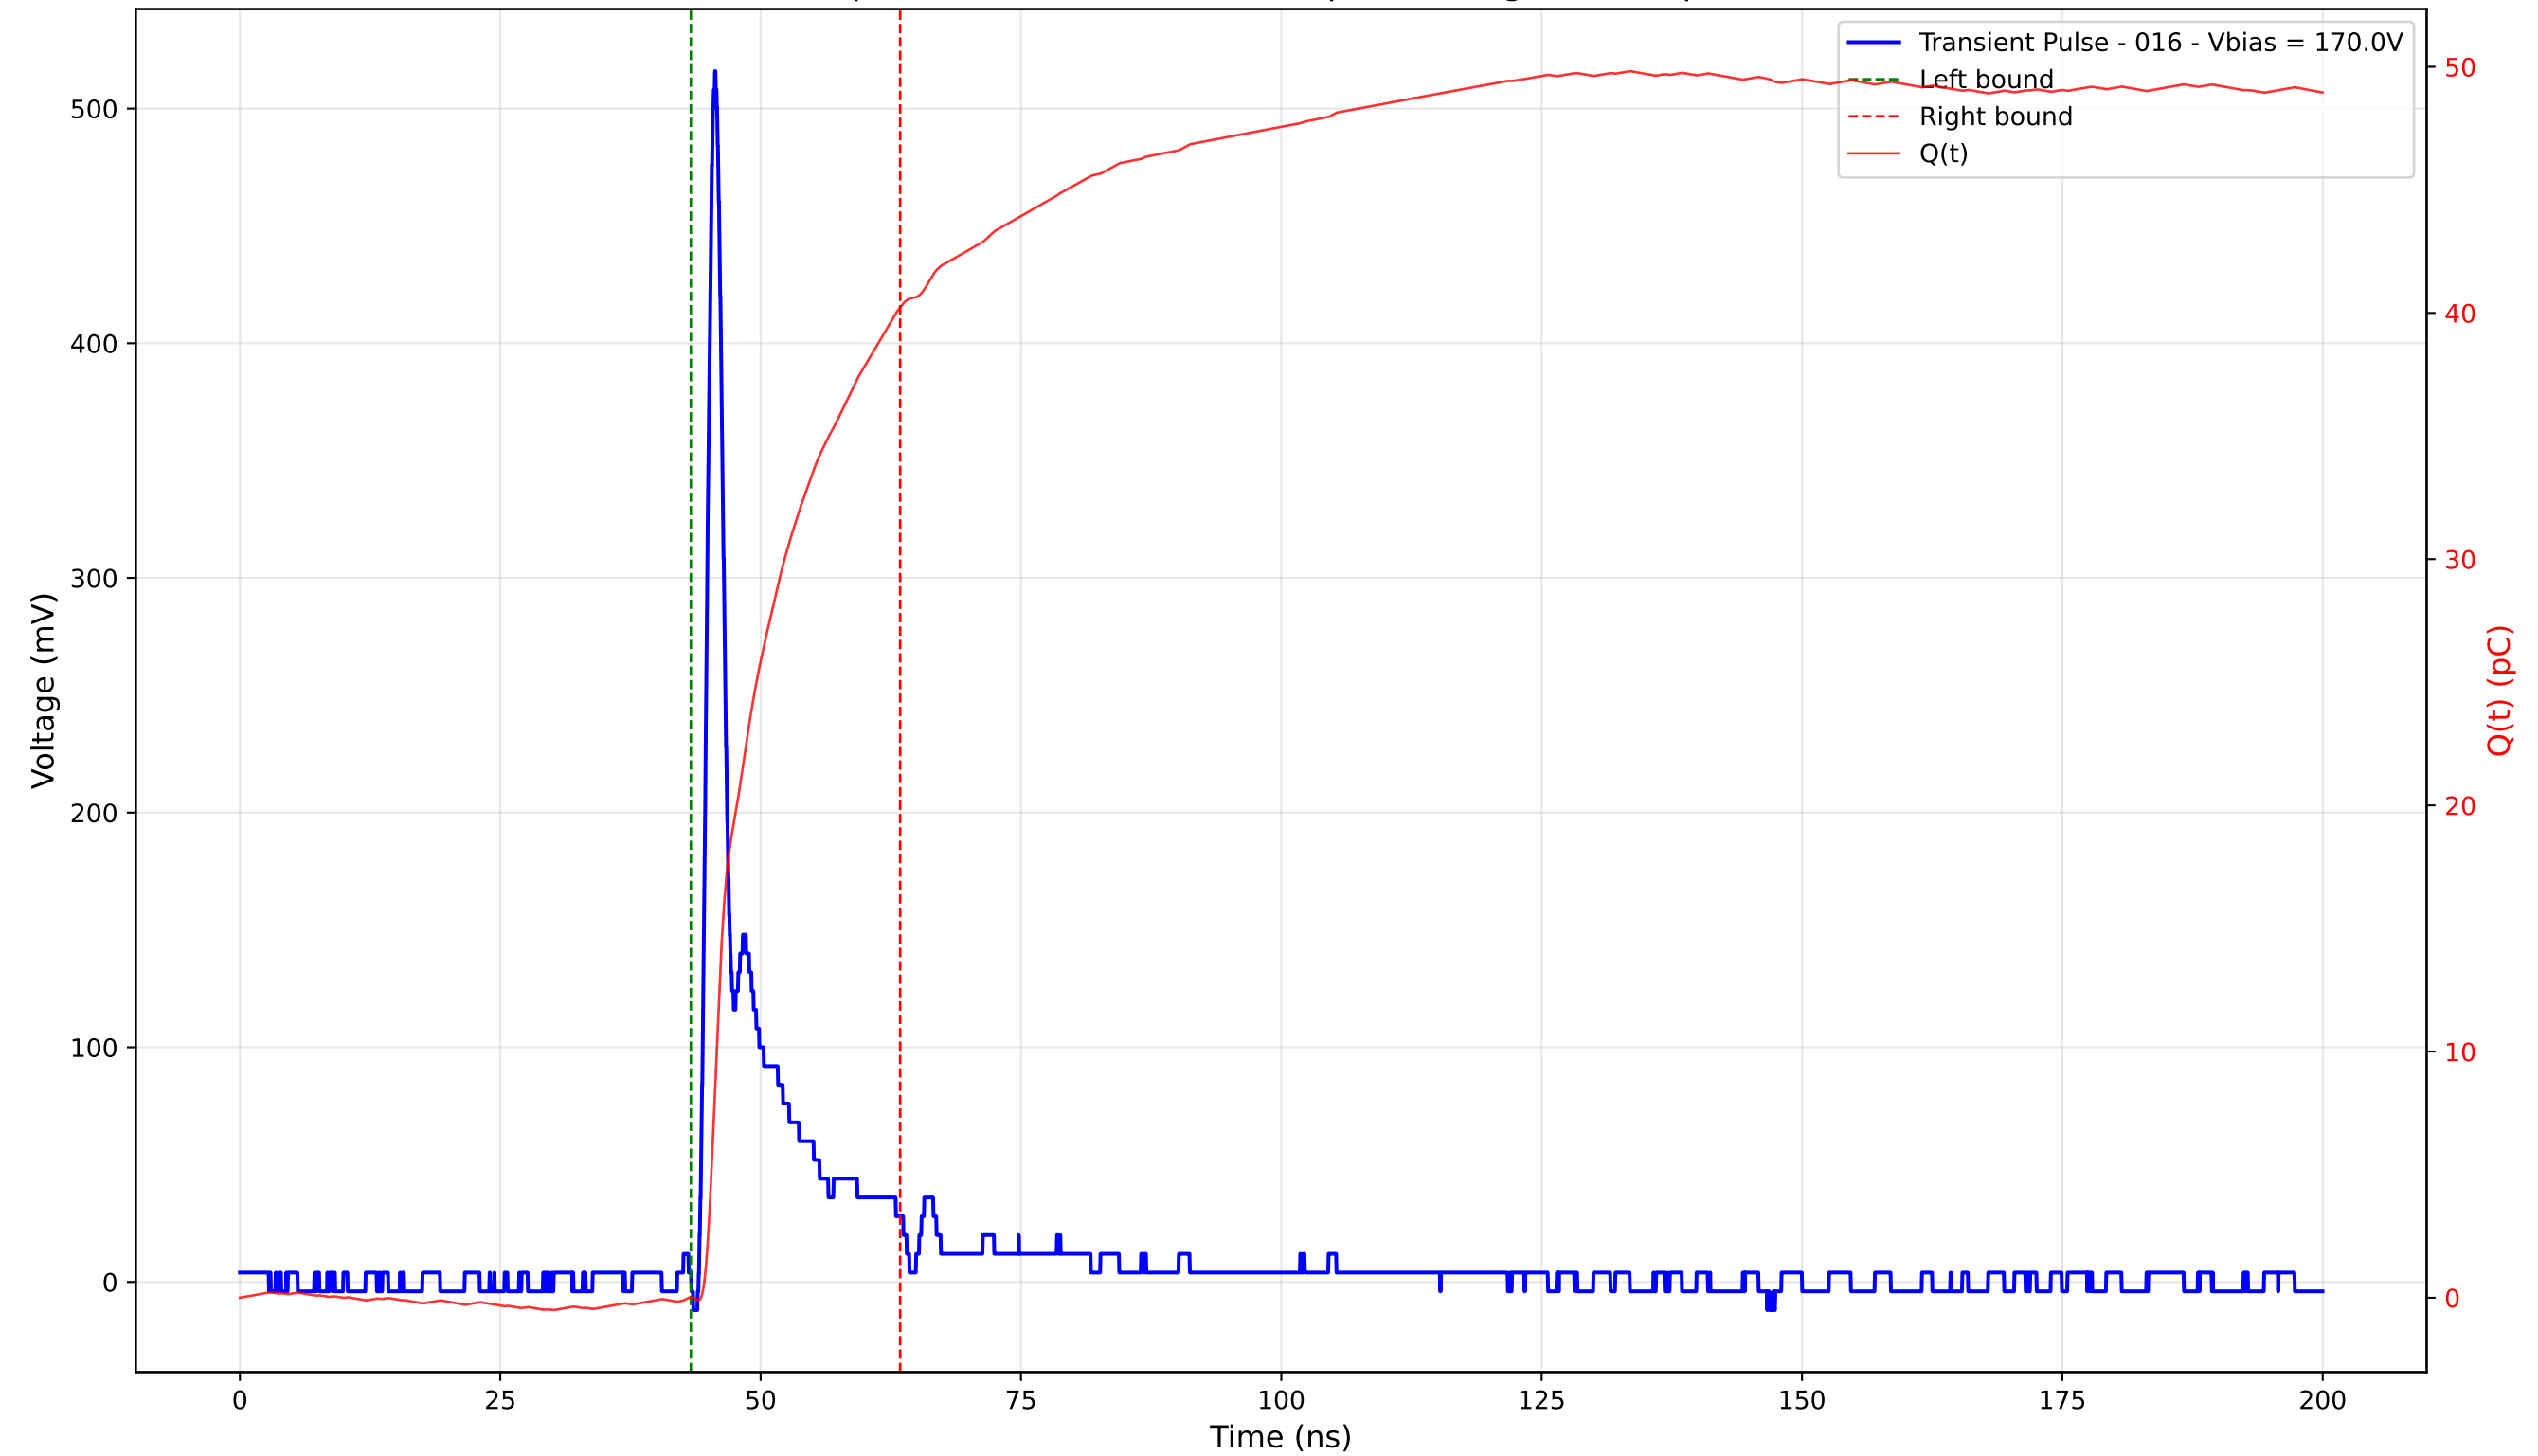


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 40.86 pC - Rise Time: 1.02 ns

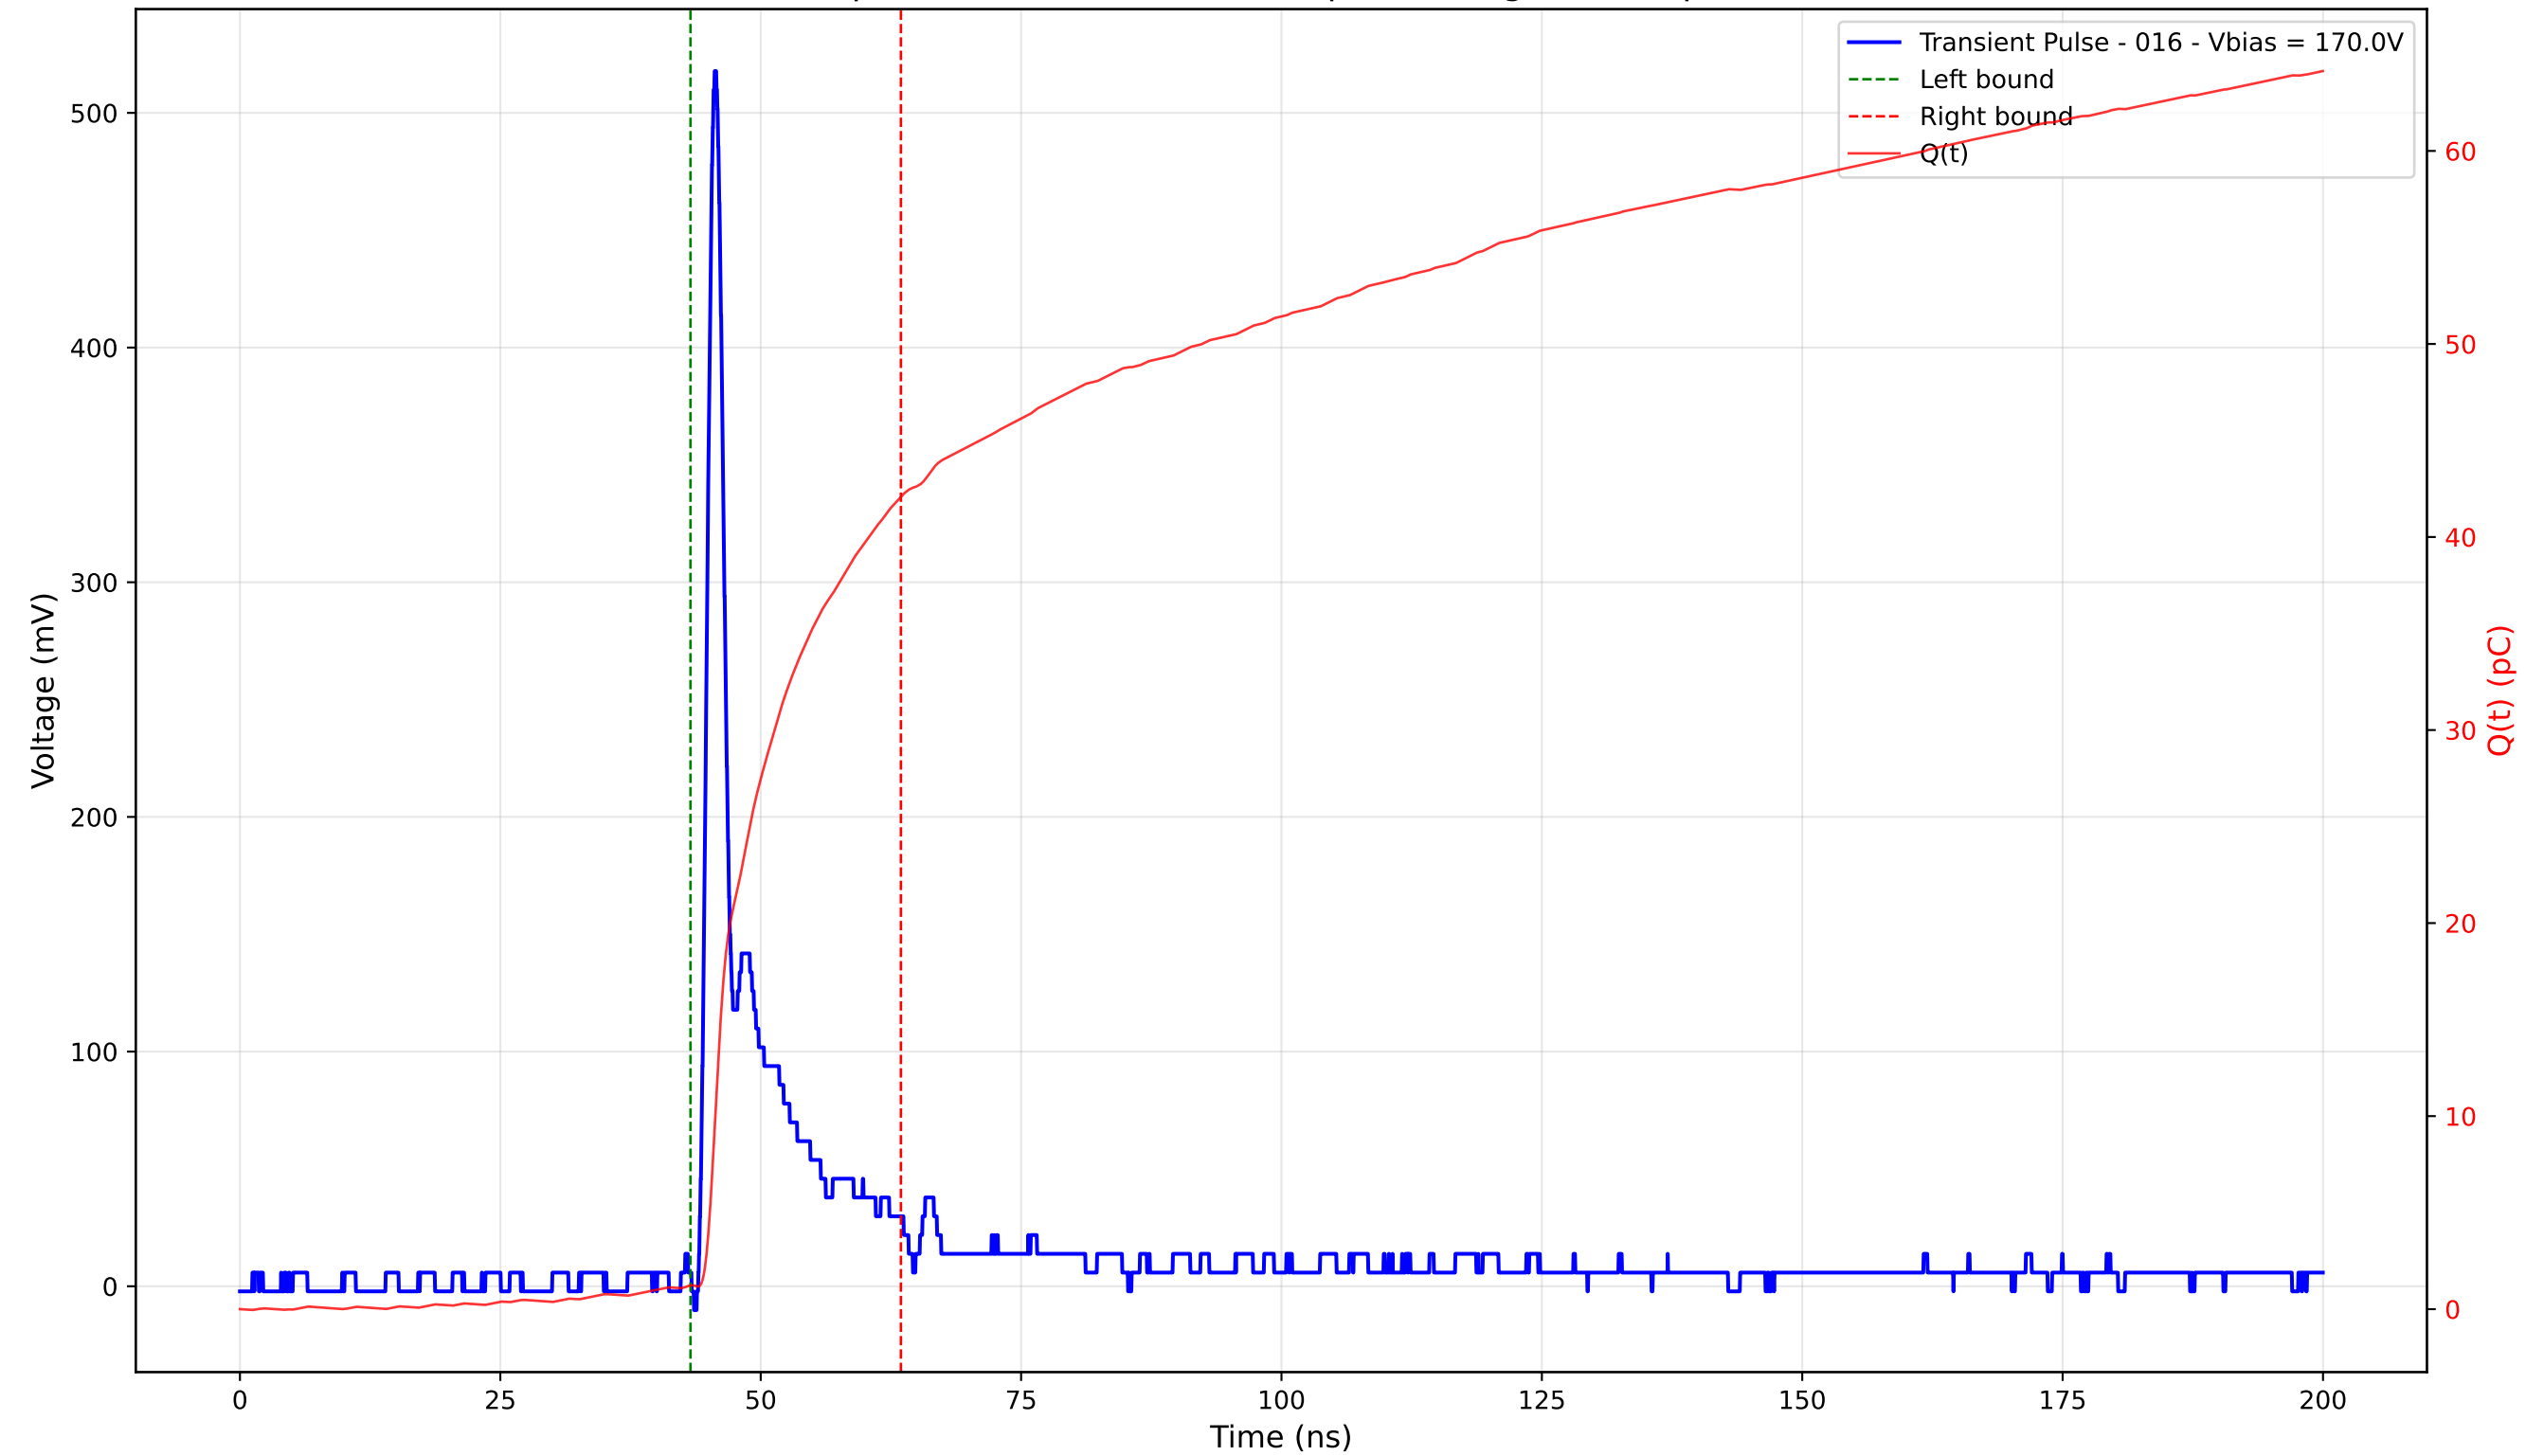


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 40.97 pC - Rise Time: 1.03 ns

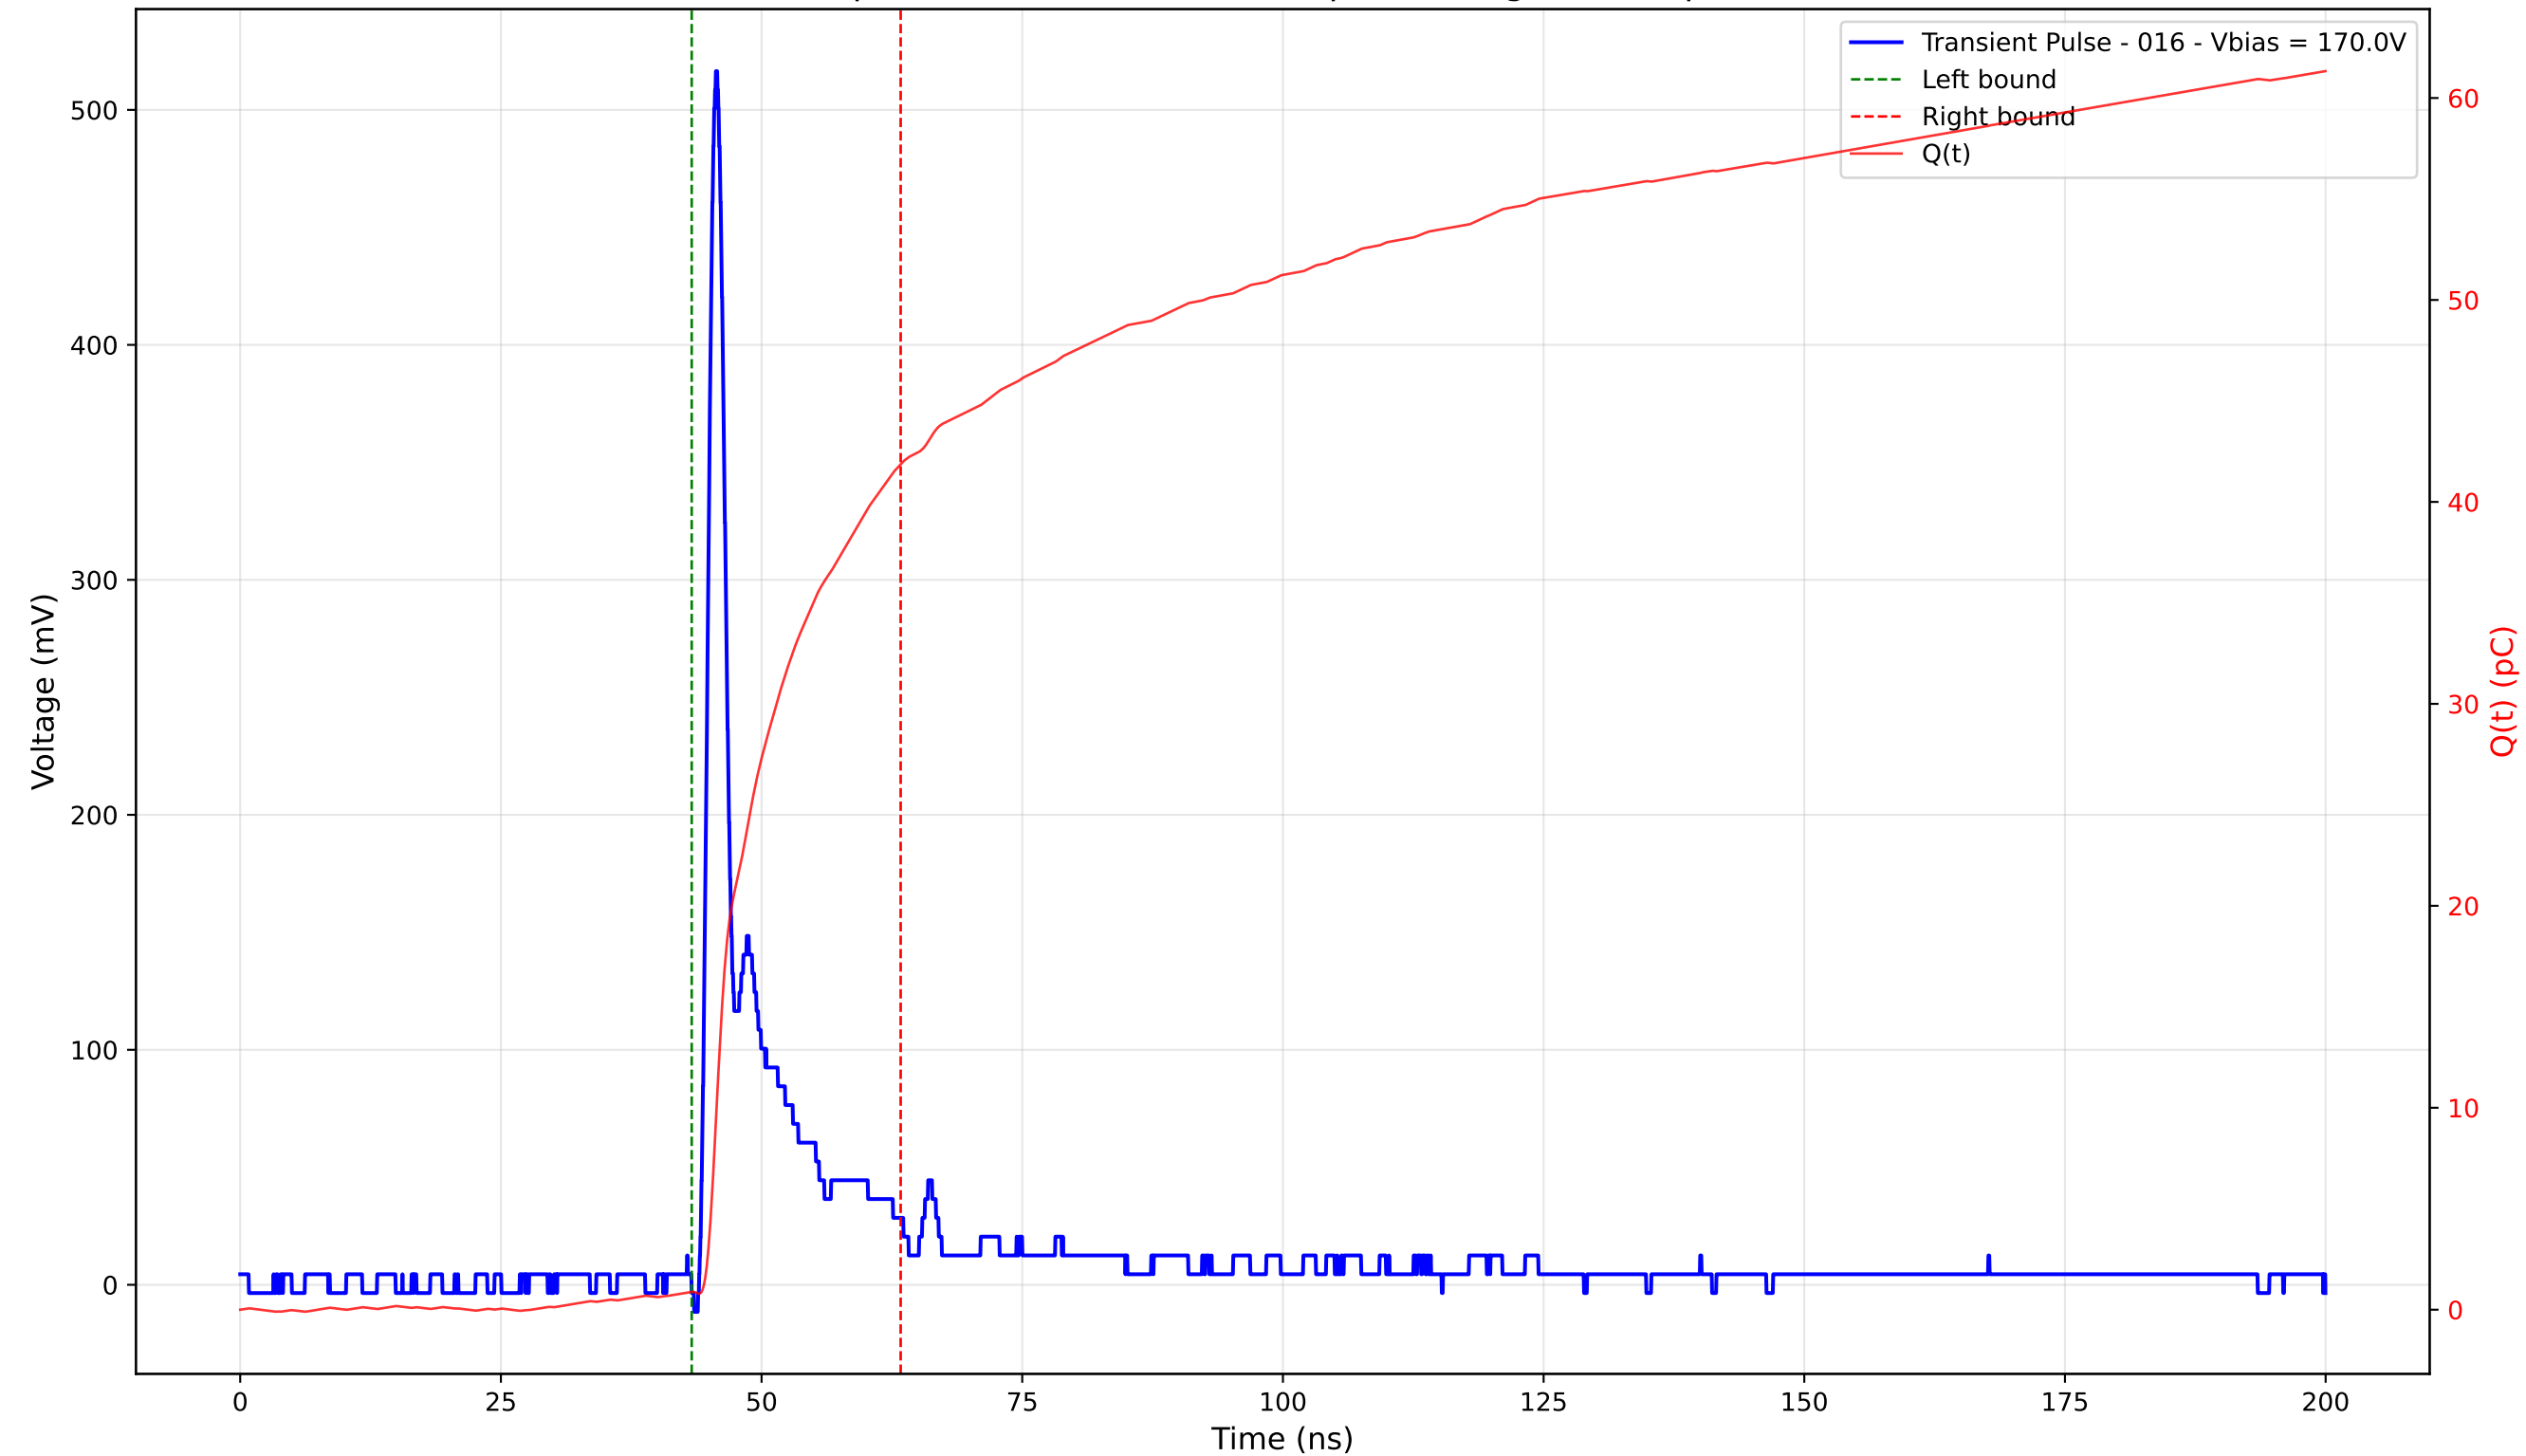


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 40.85 pC - Rise Time: 1.04 ns

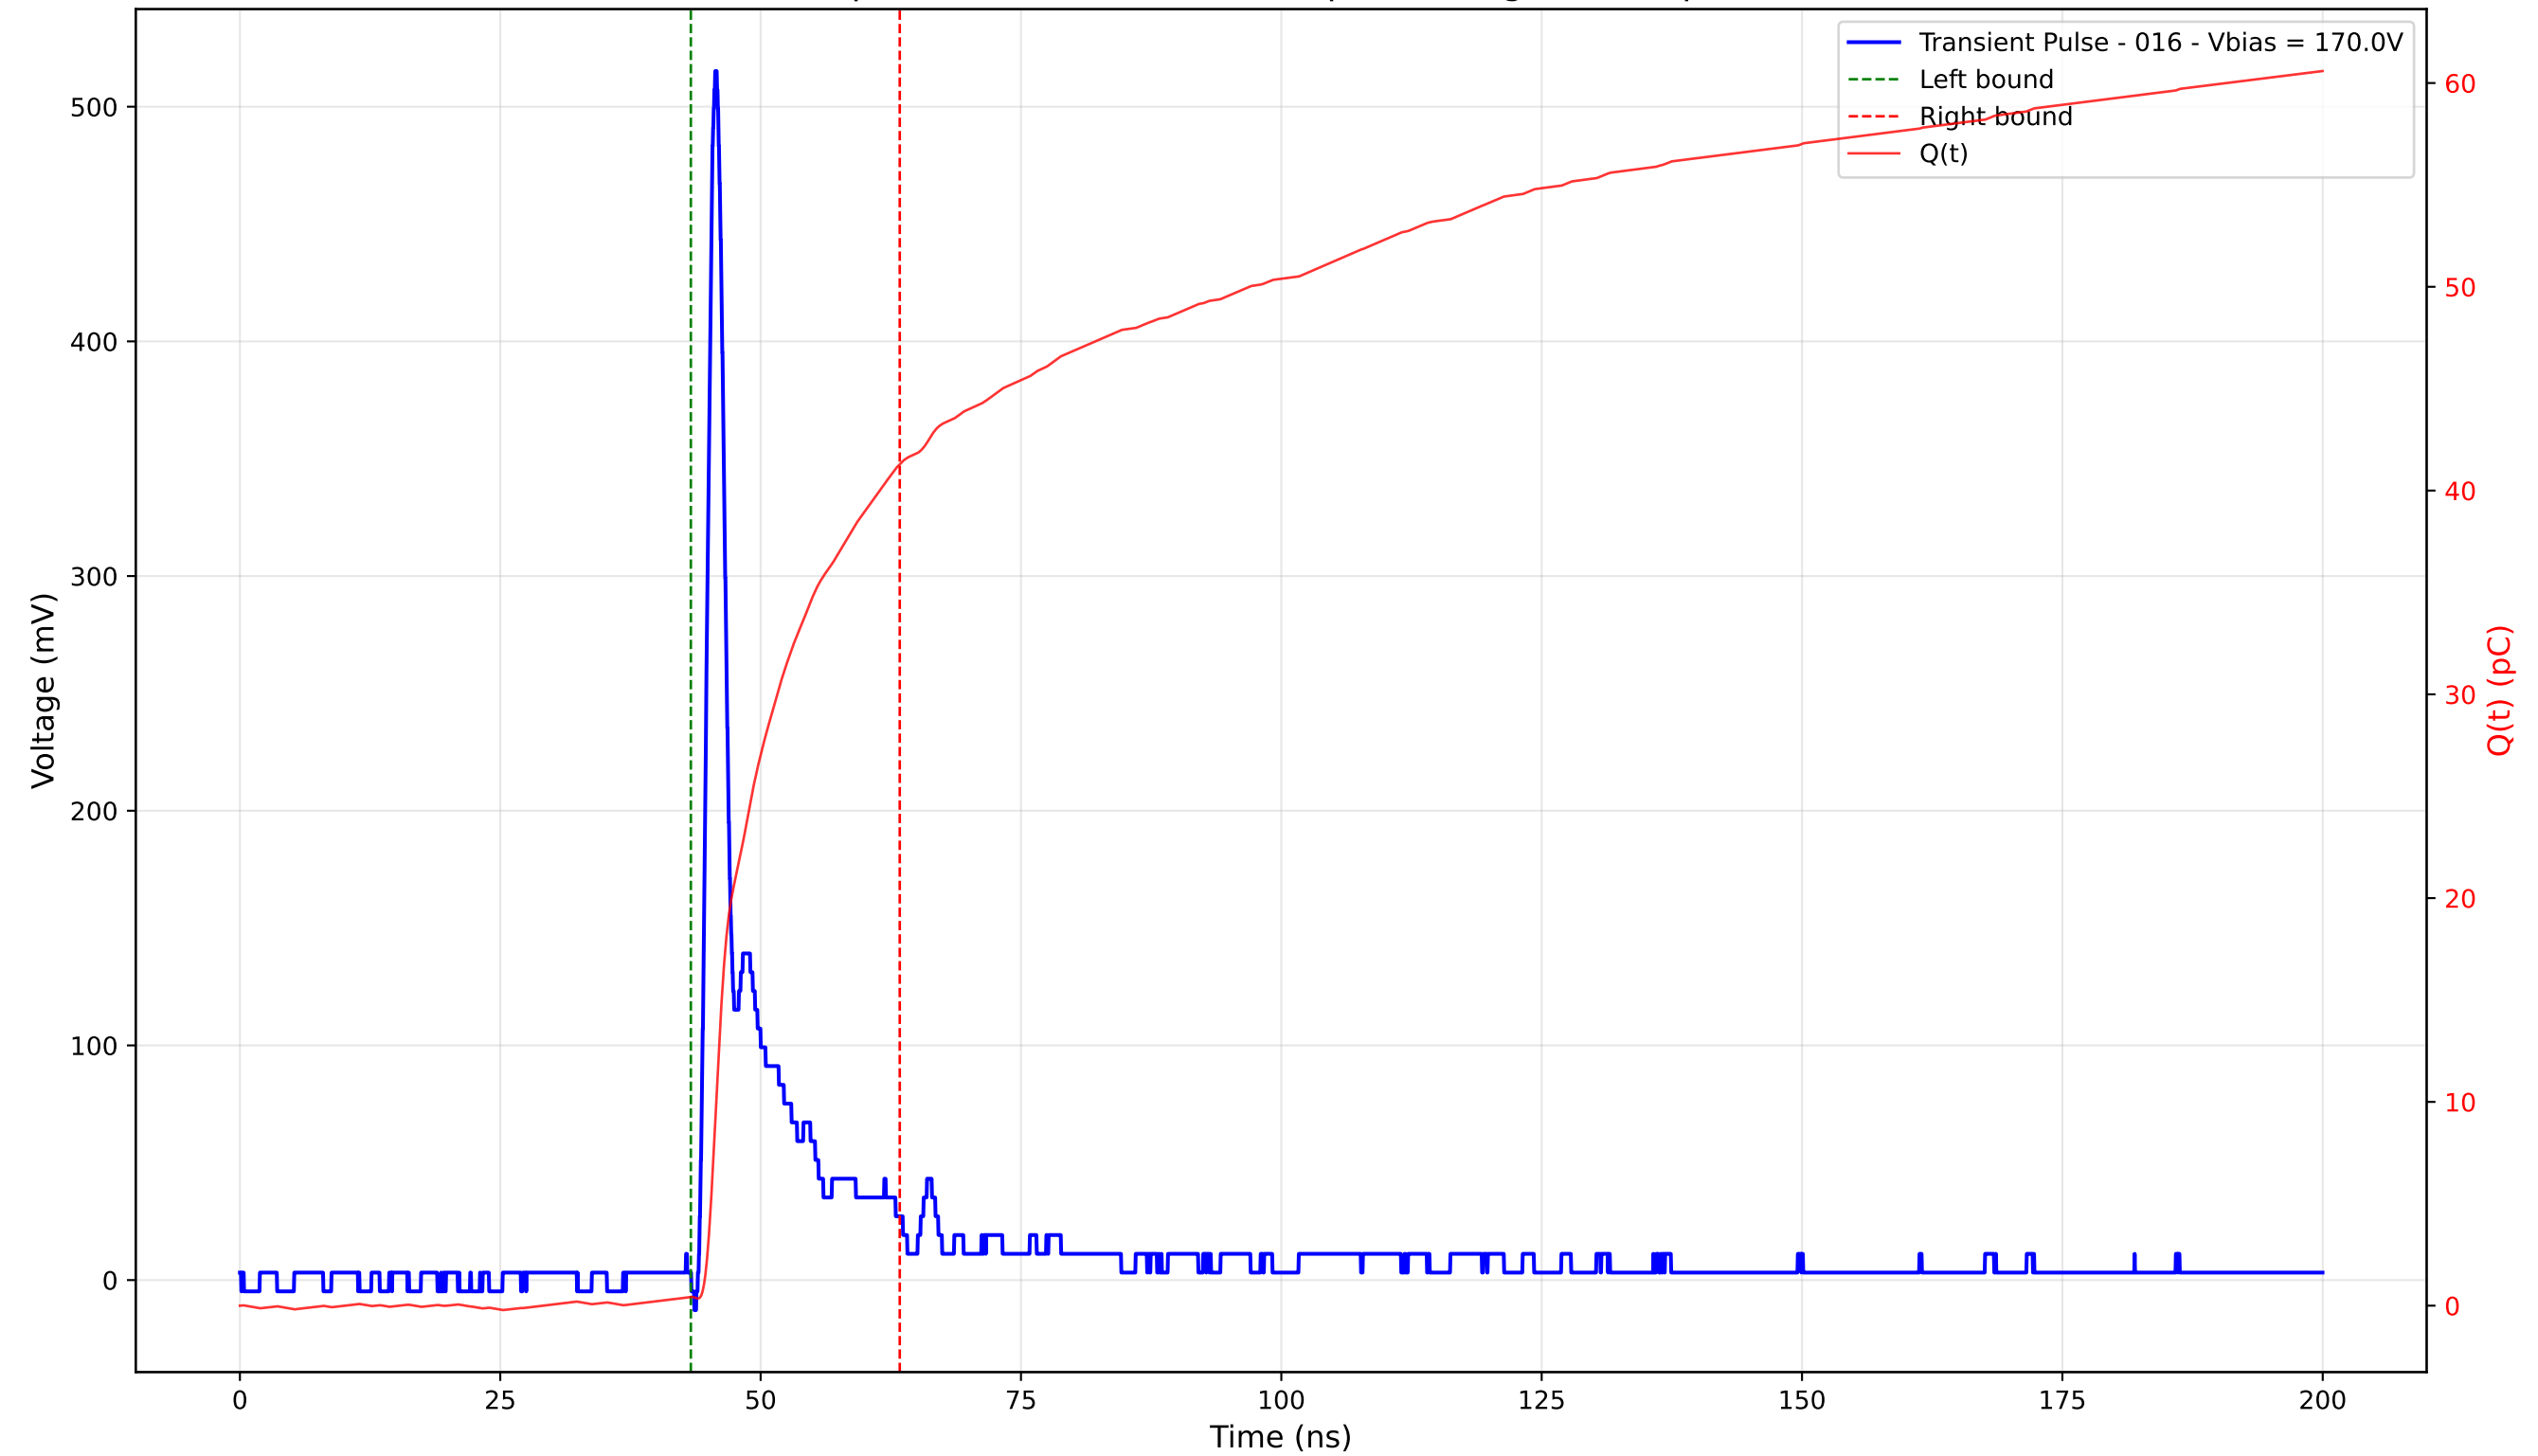


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 40.55 pC - Rise Time: 1.05 ns

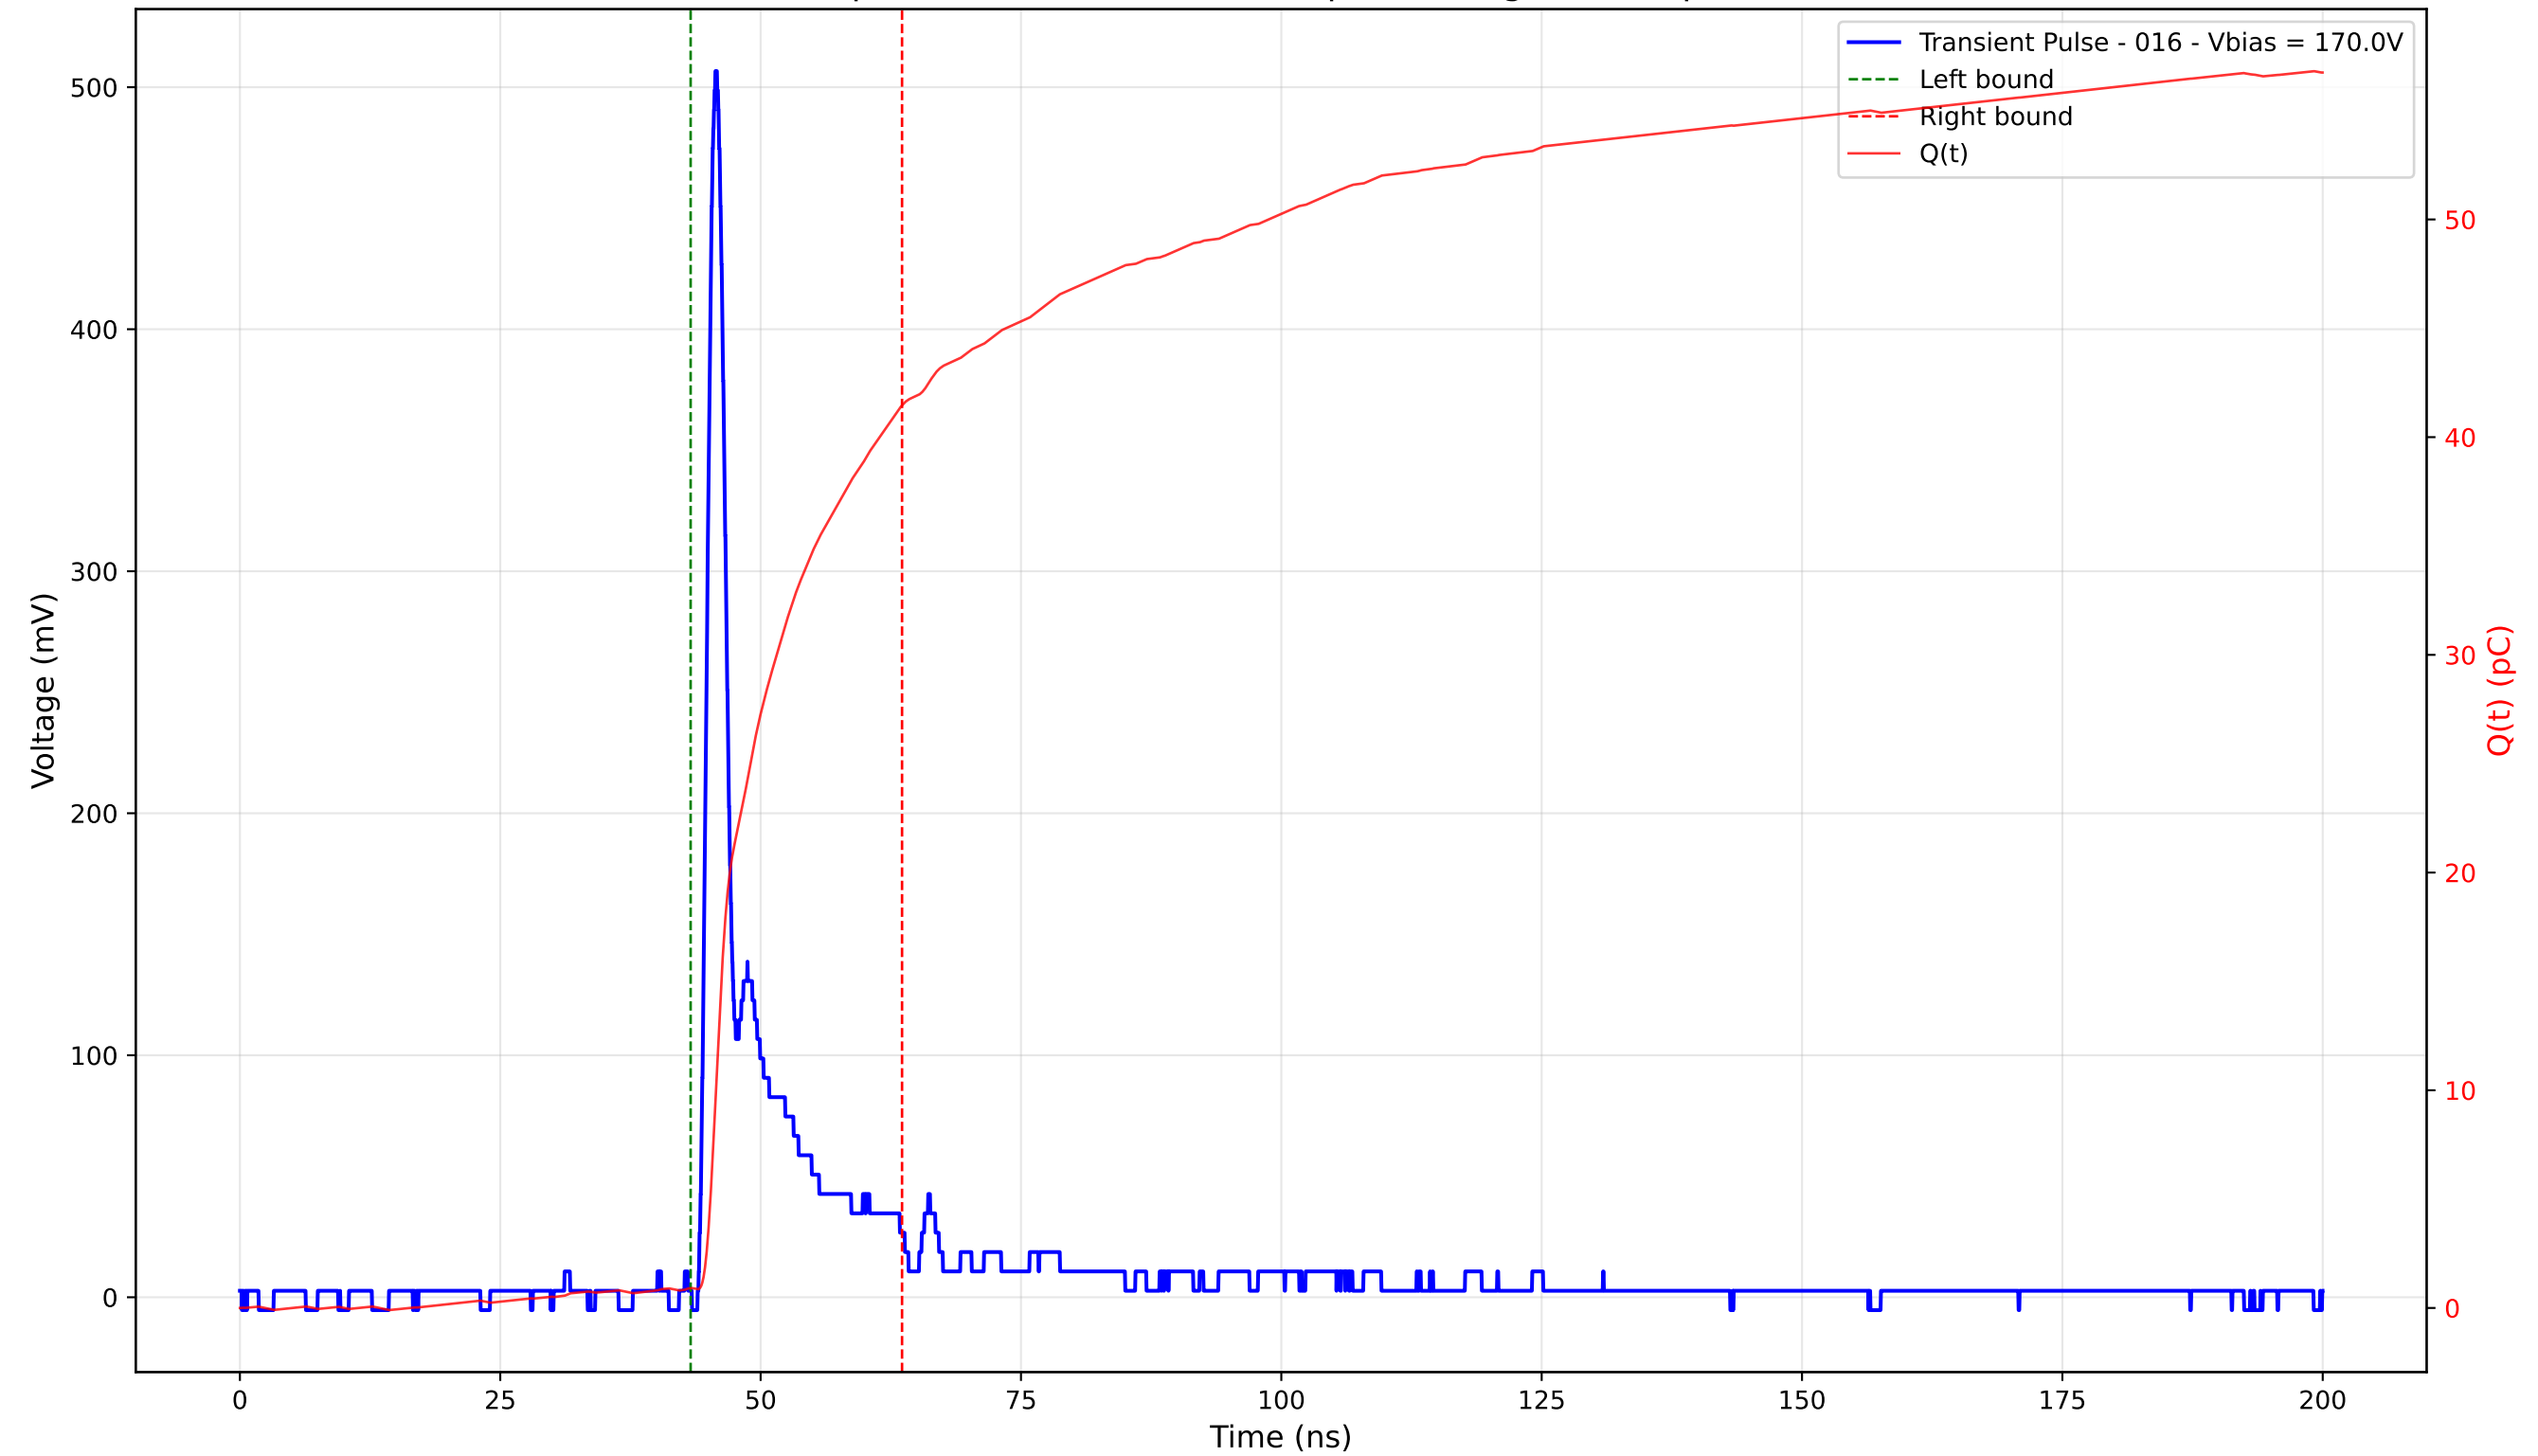


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 39.55 pC - Rise Time: 1.08 ns

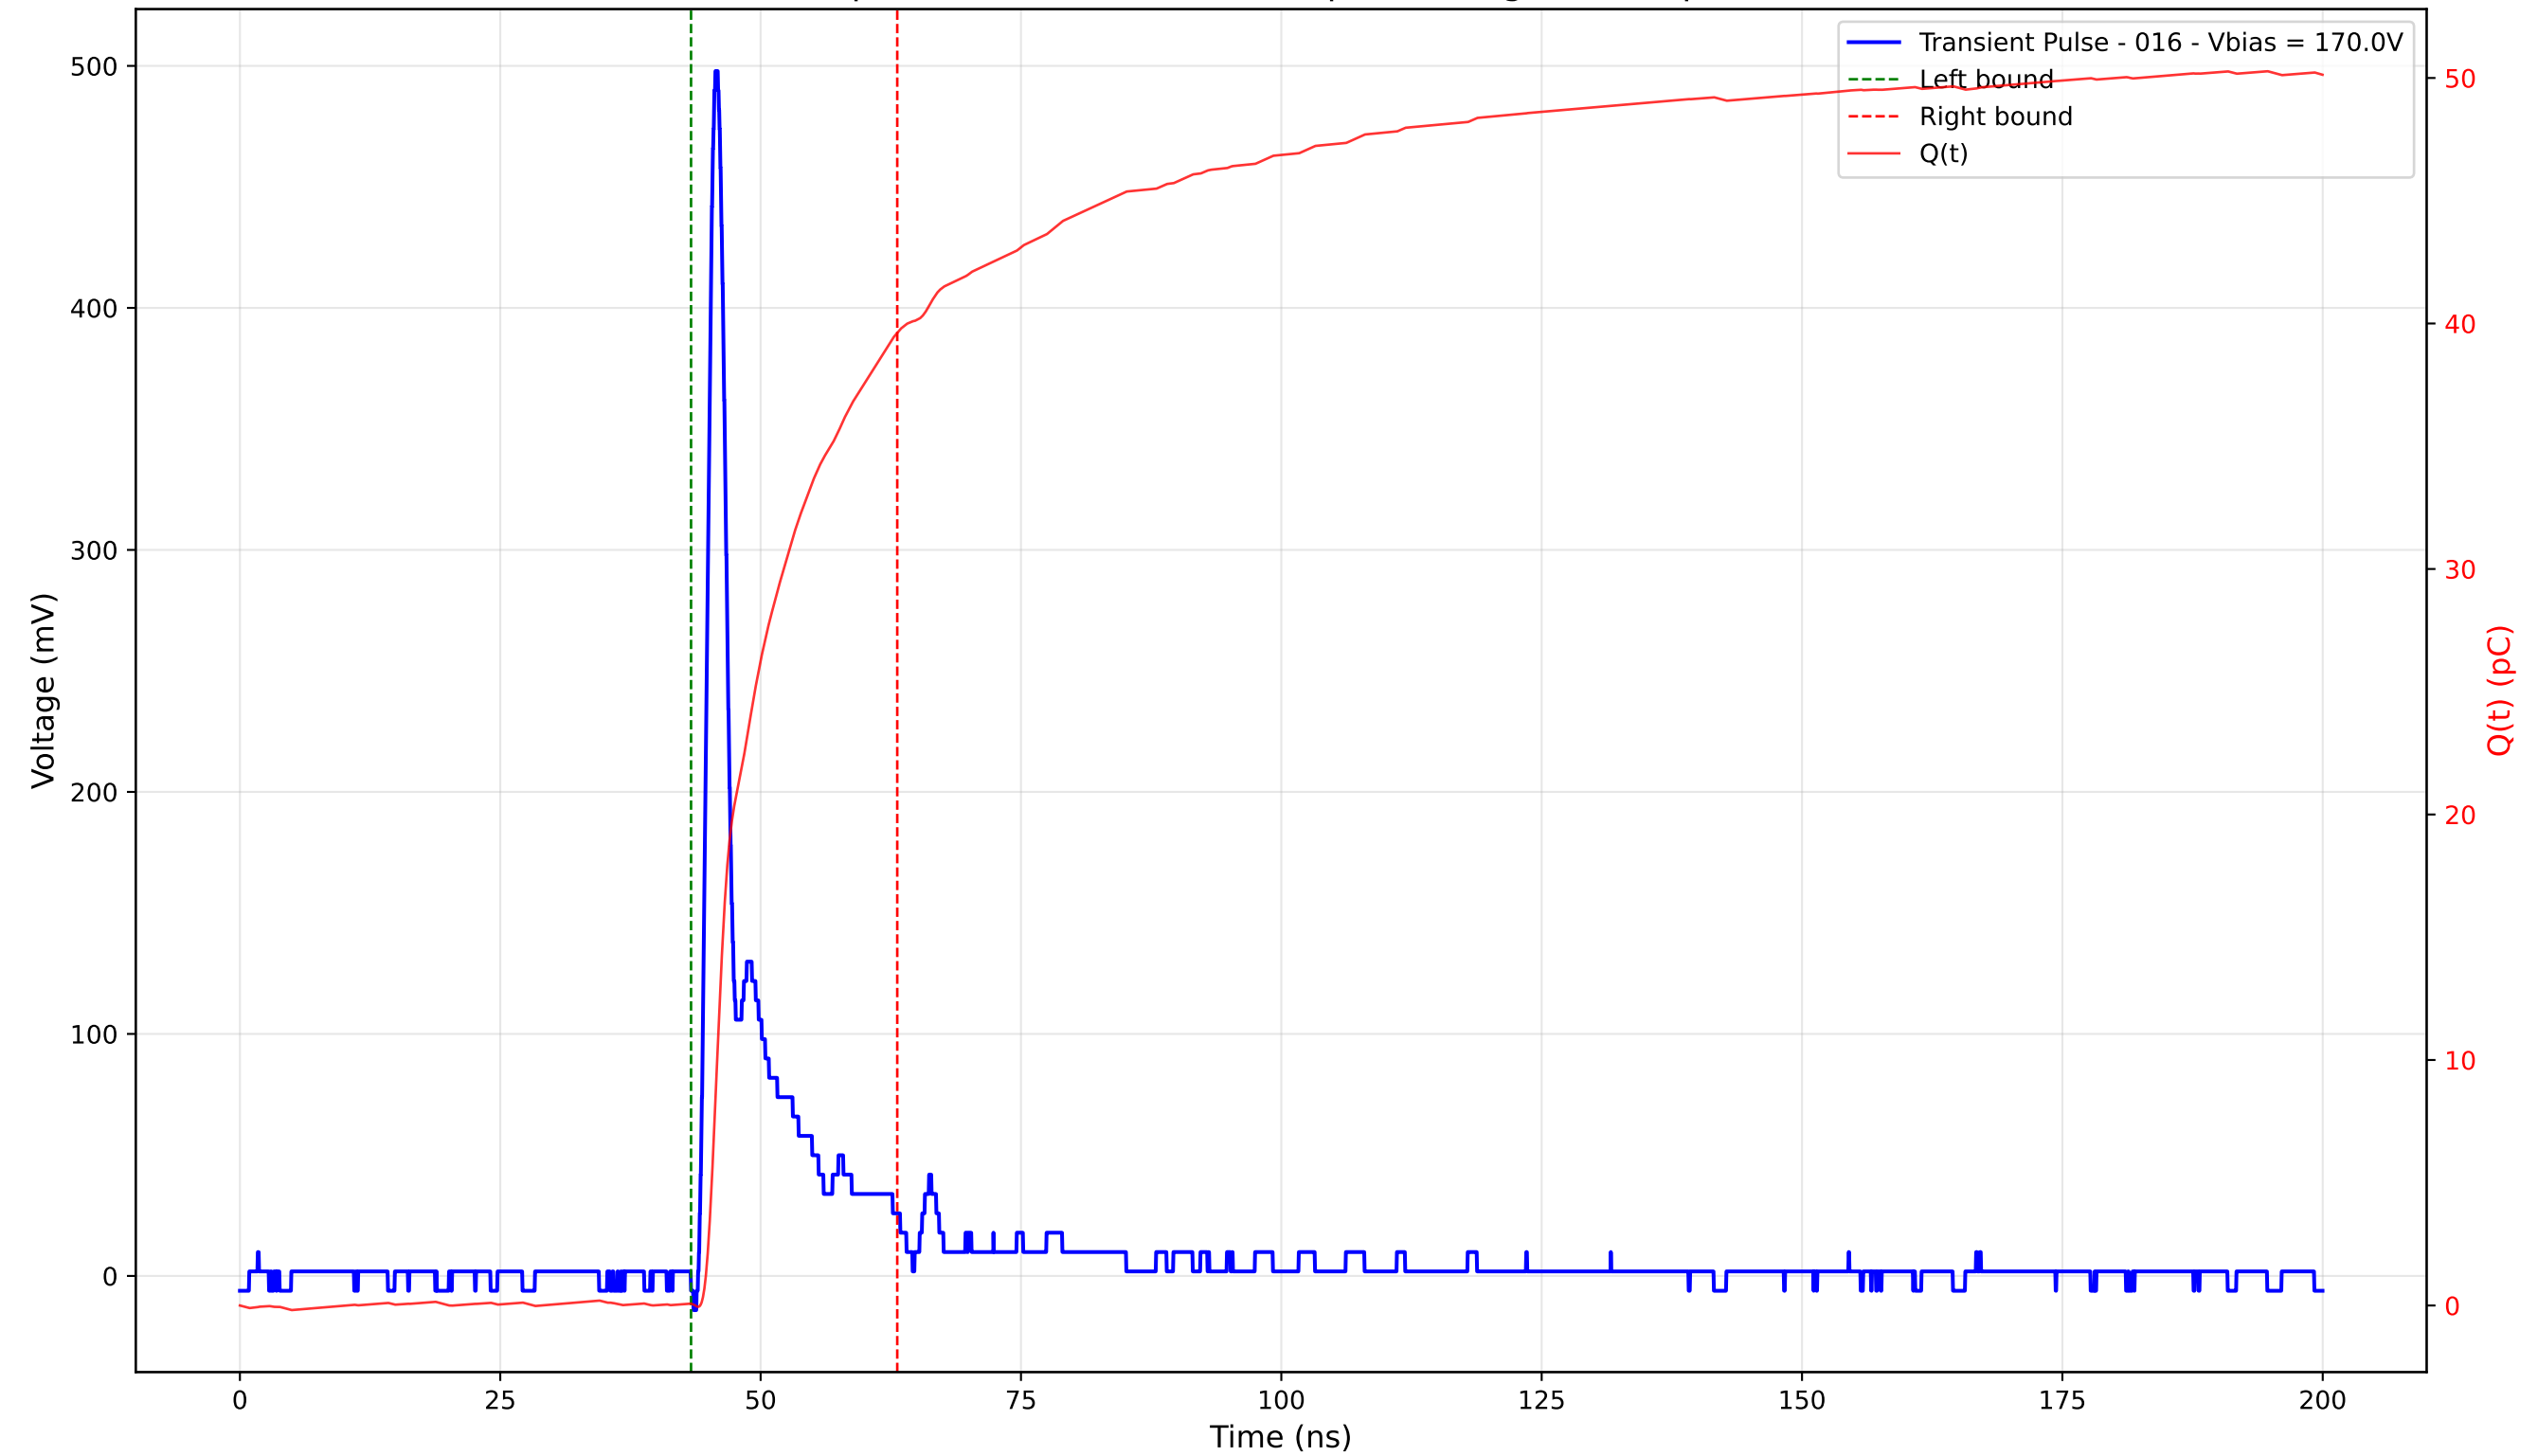


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 39.19 pC - Rise Time: 1.10 ns

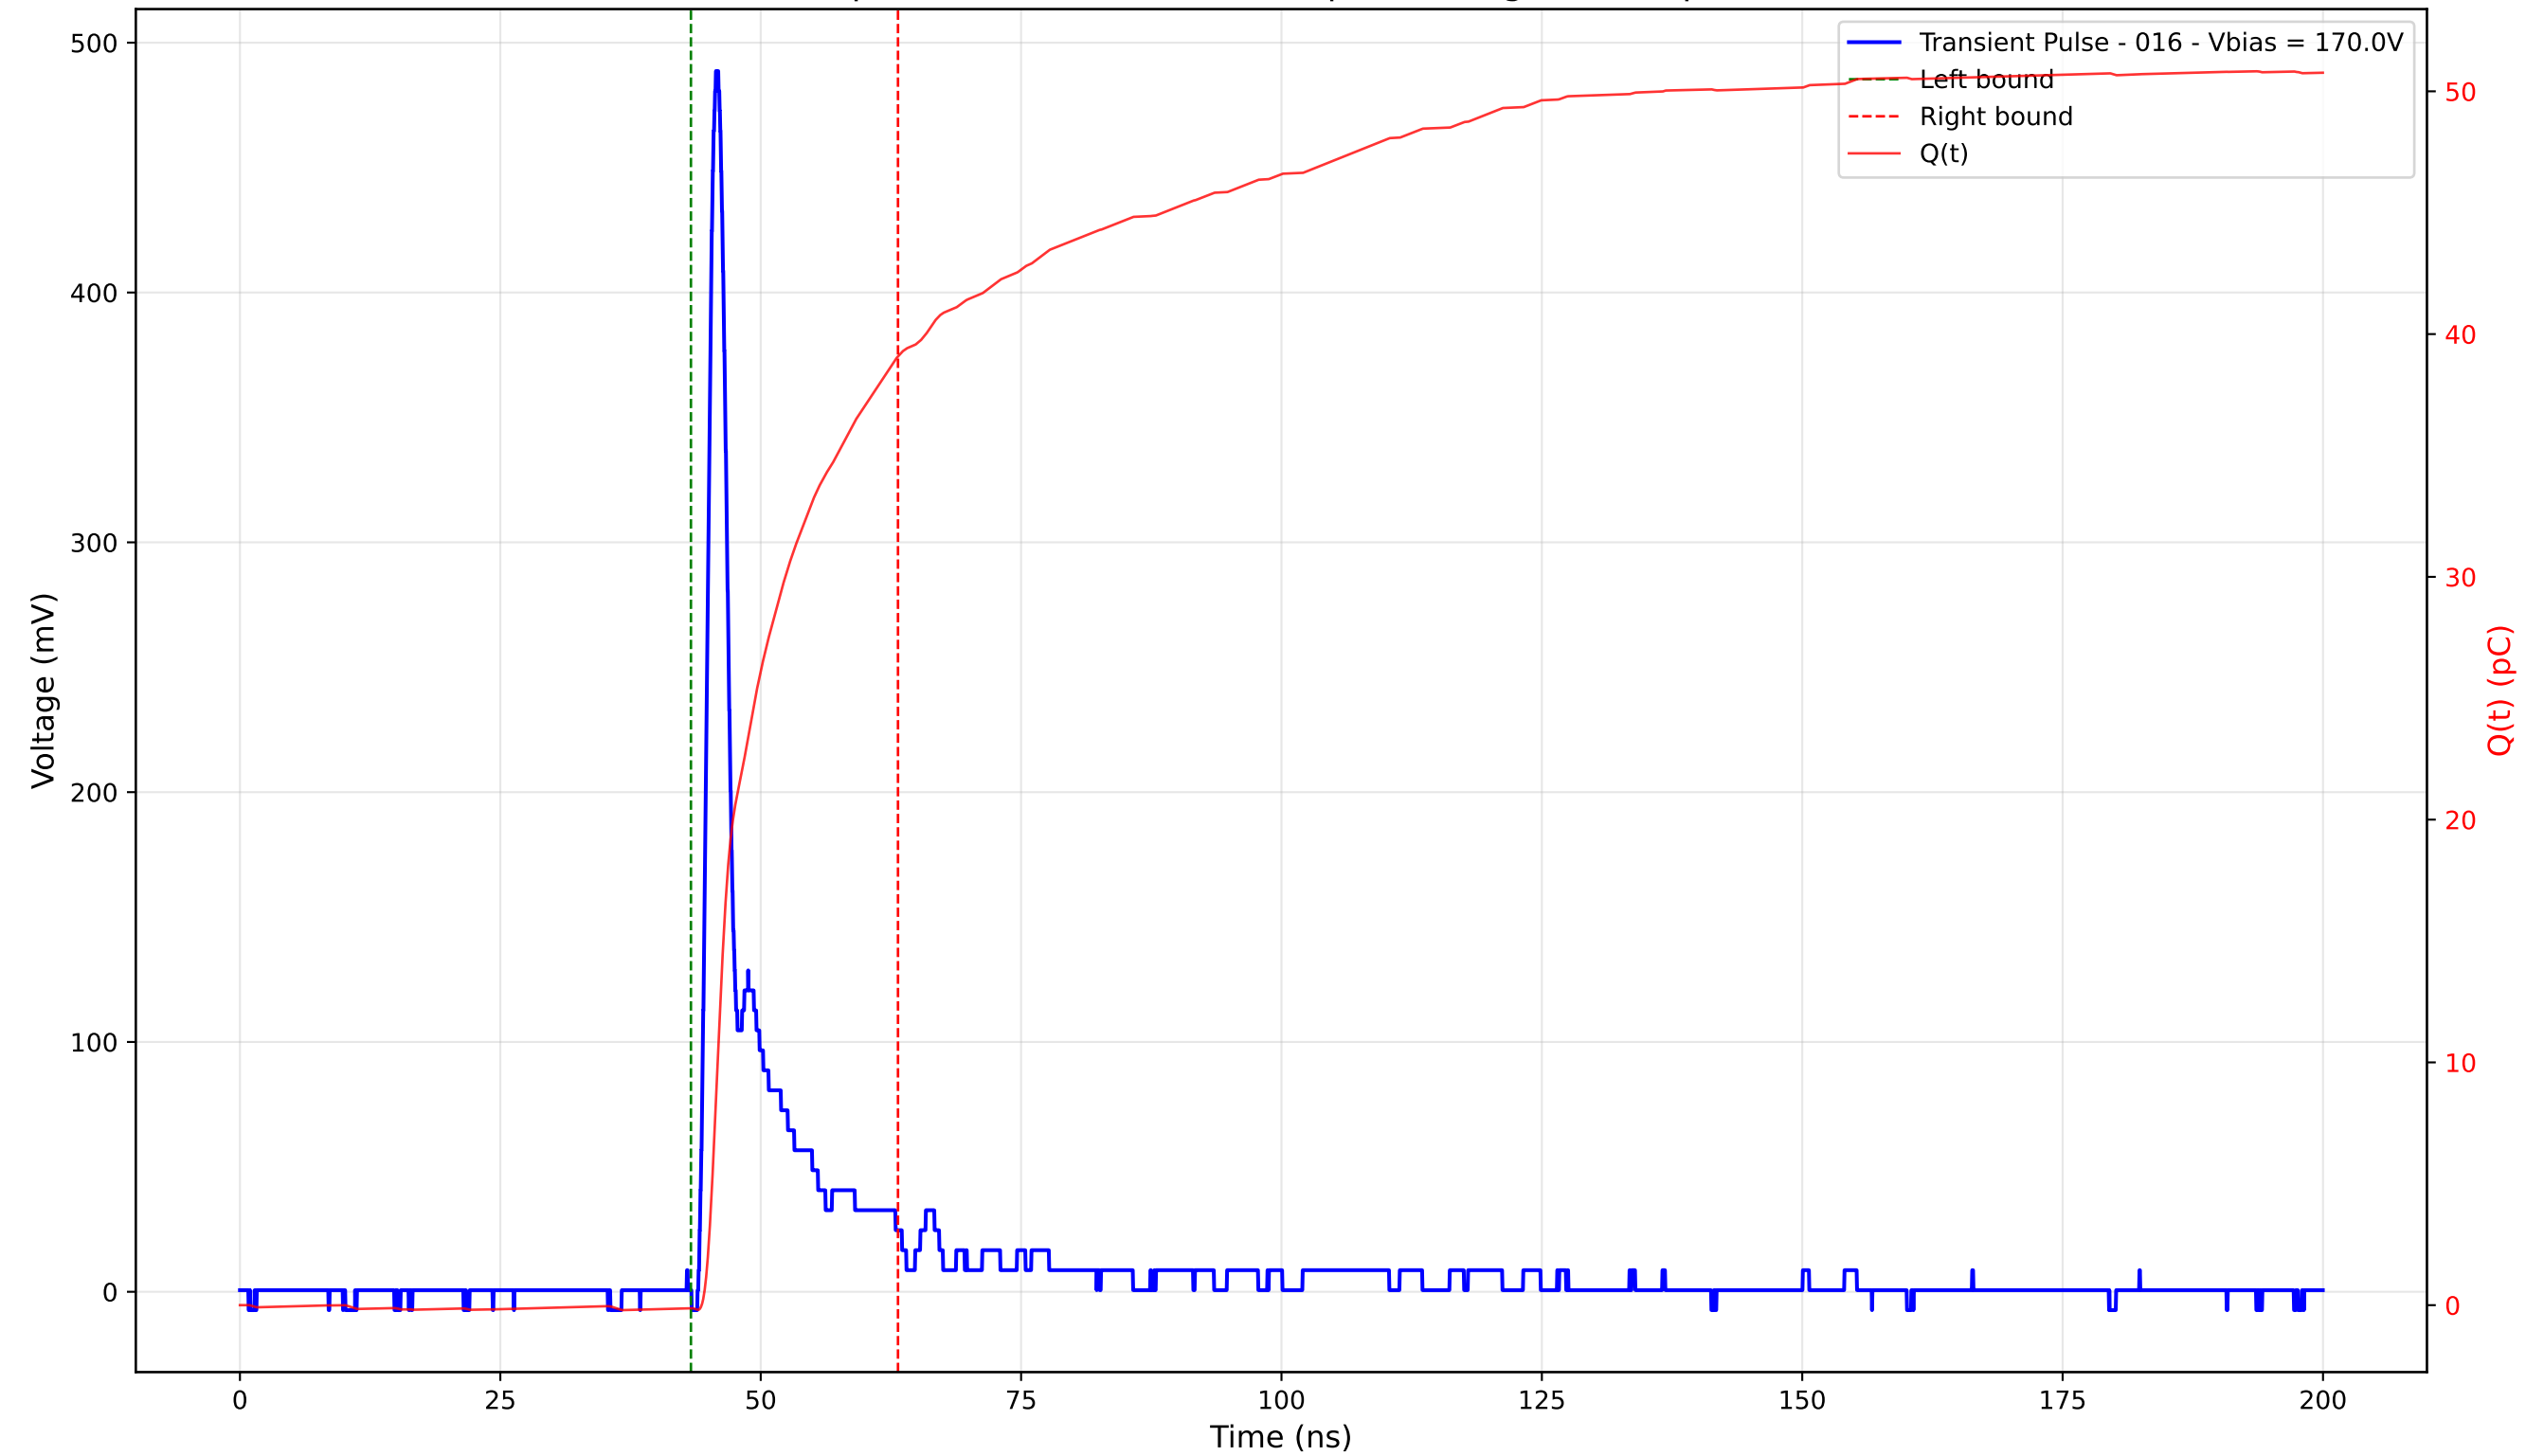


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 39.46 pC - Rise Time: 1.08 ns

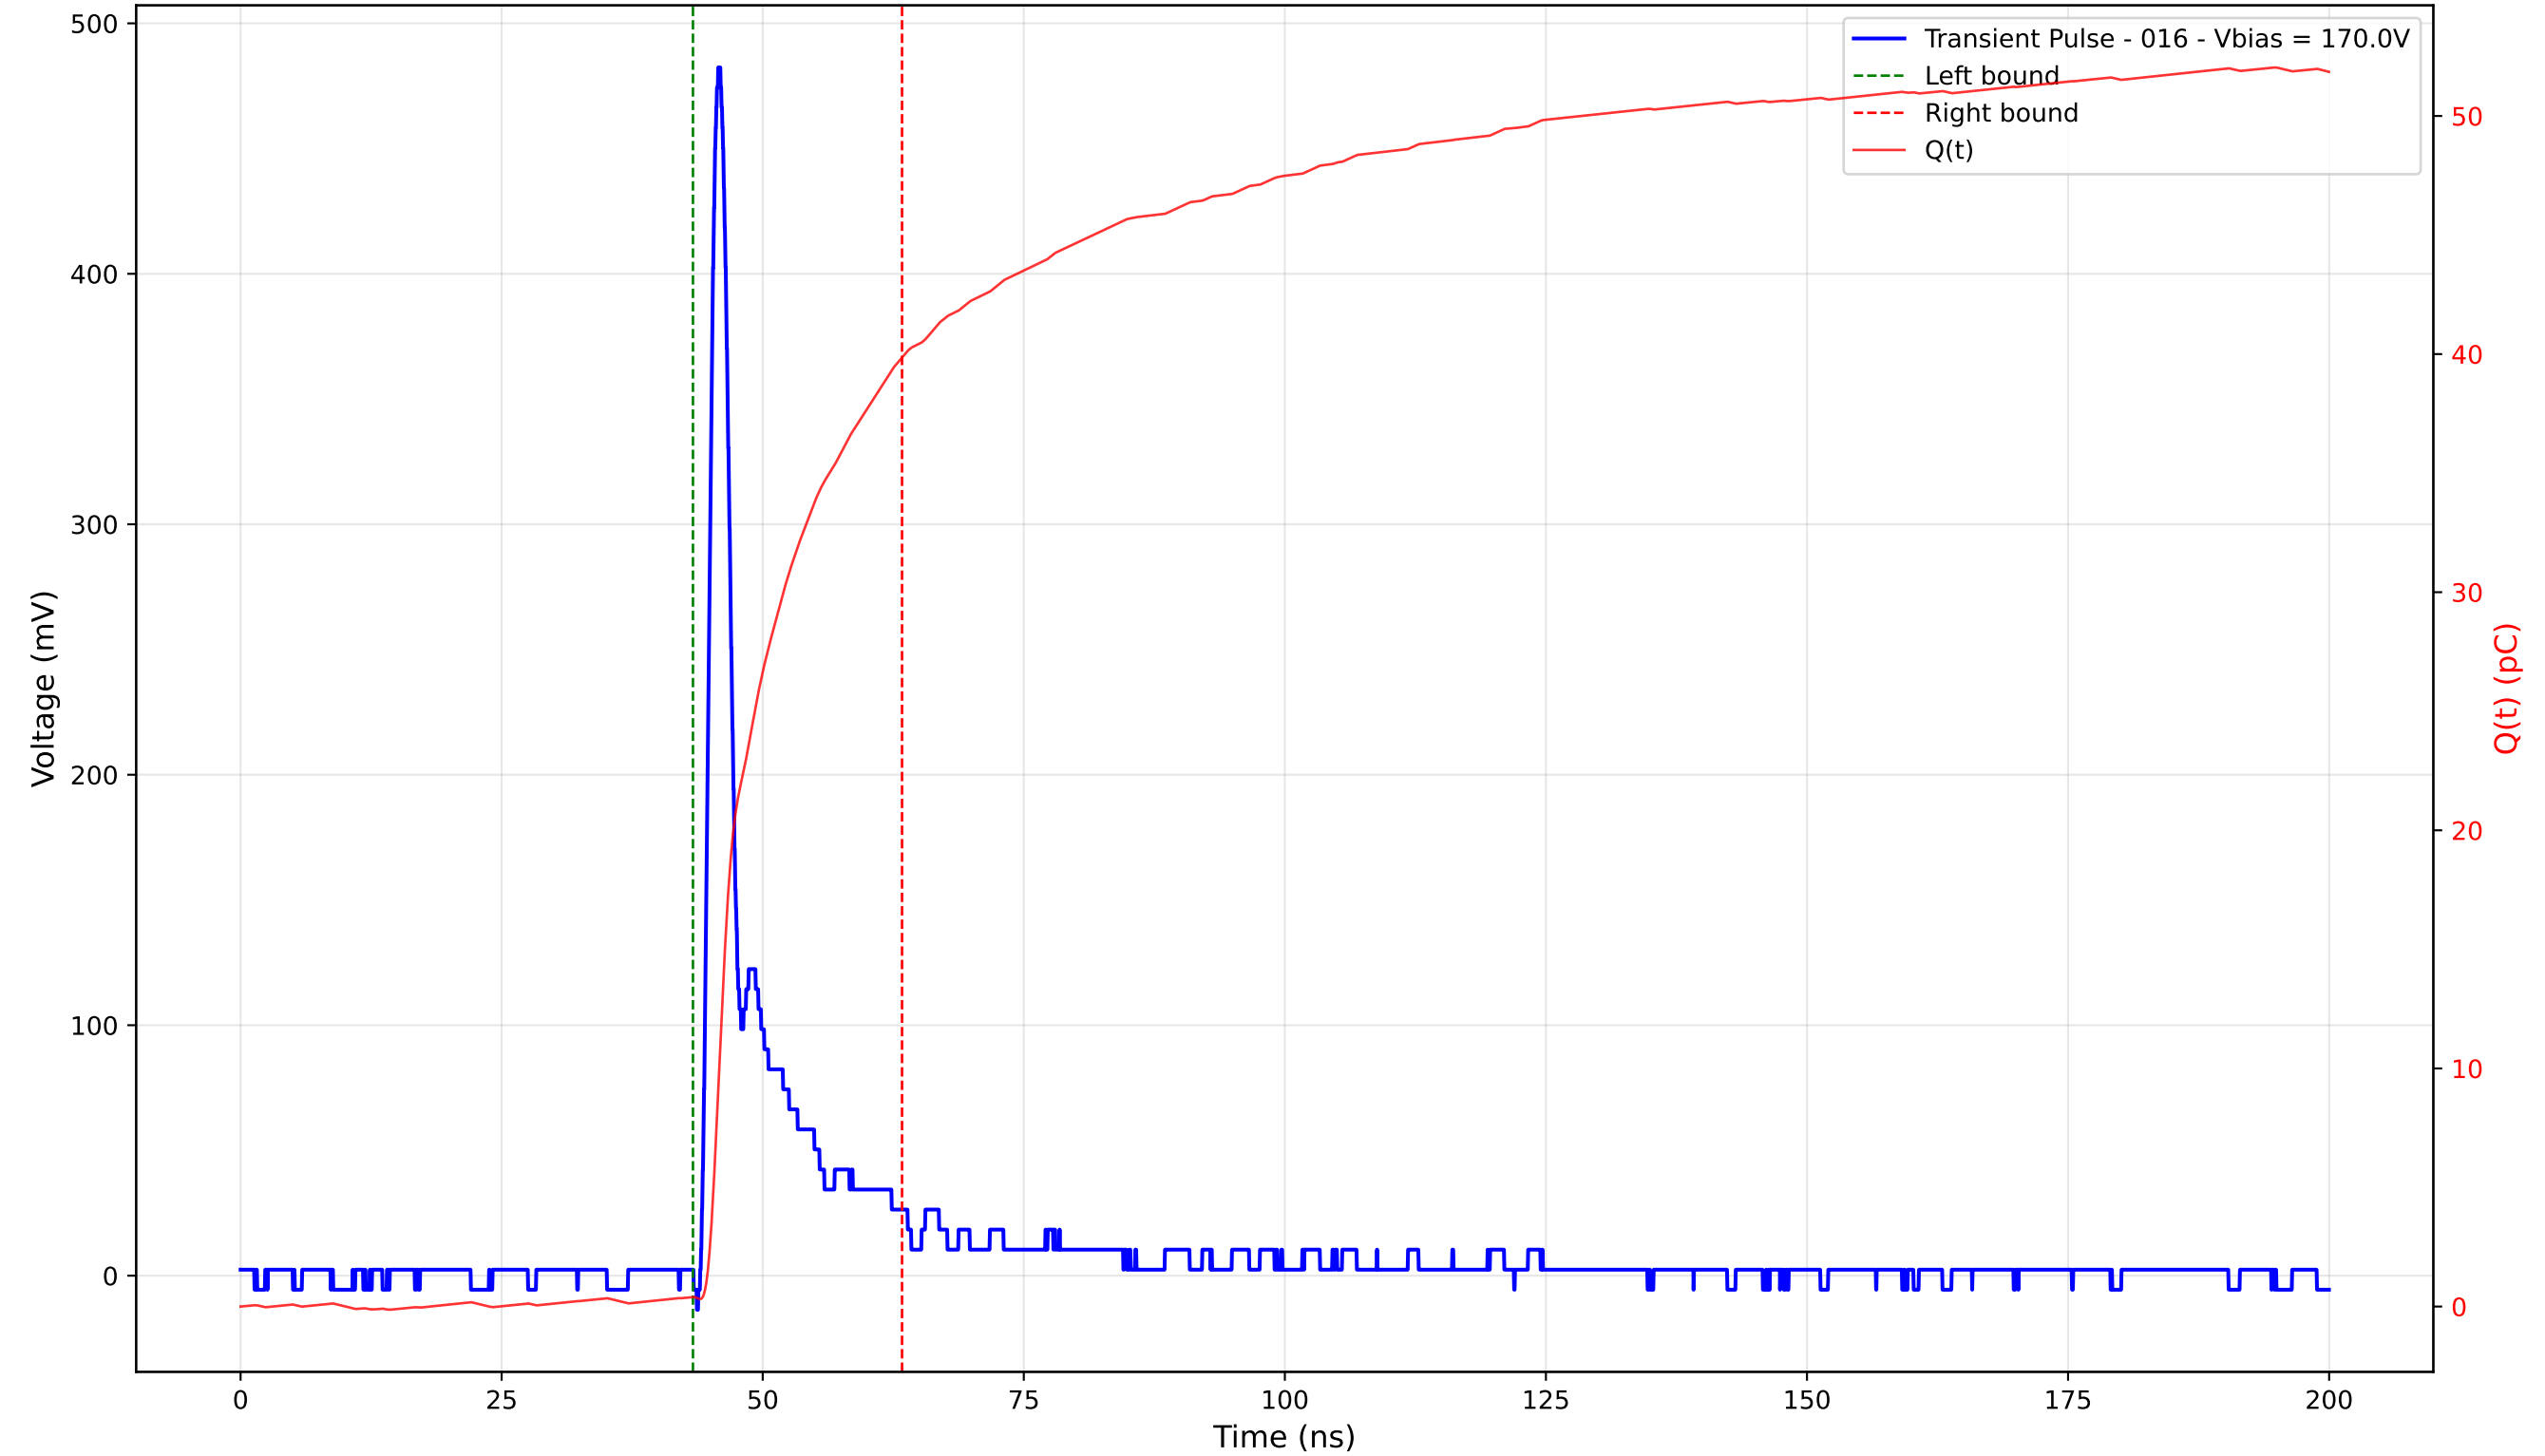


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 39.17 pC - Rise Time: 1.13 ns

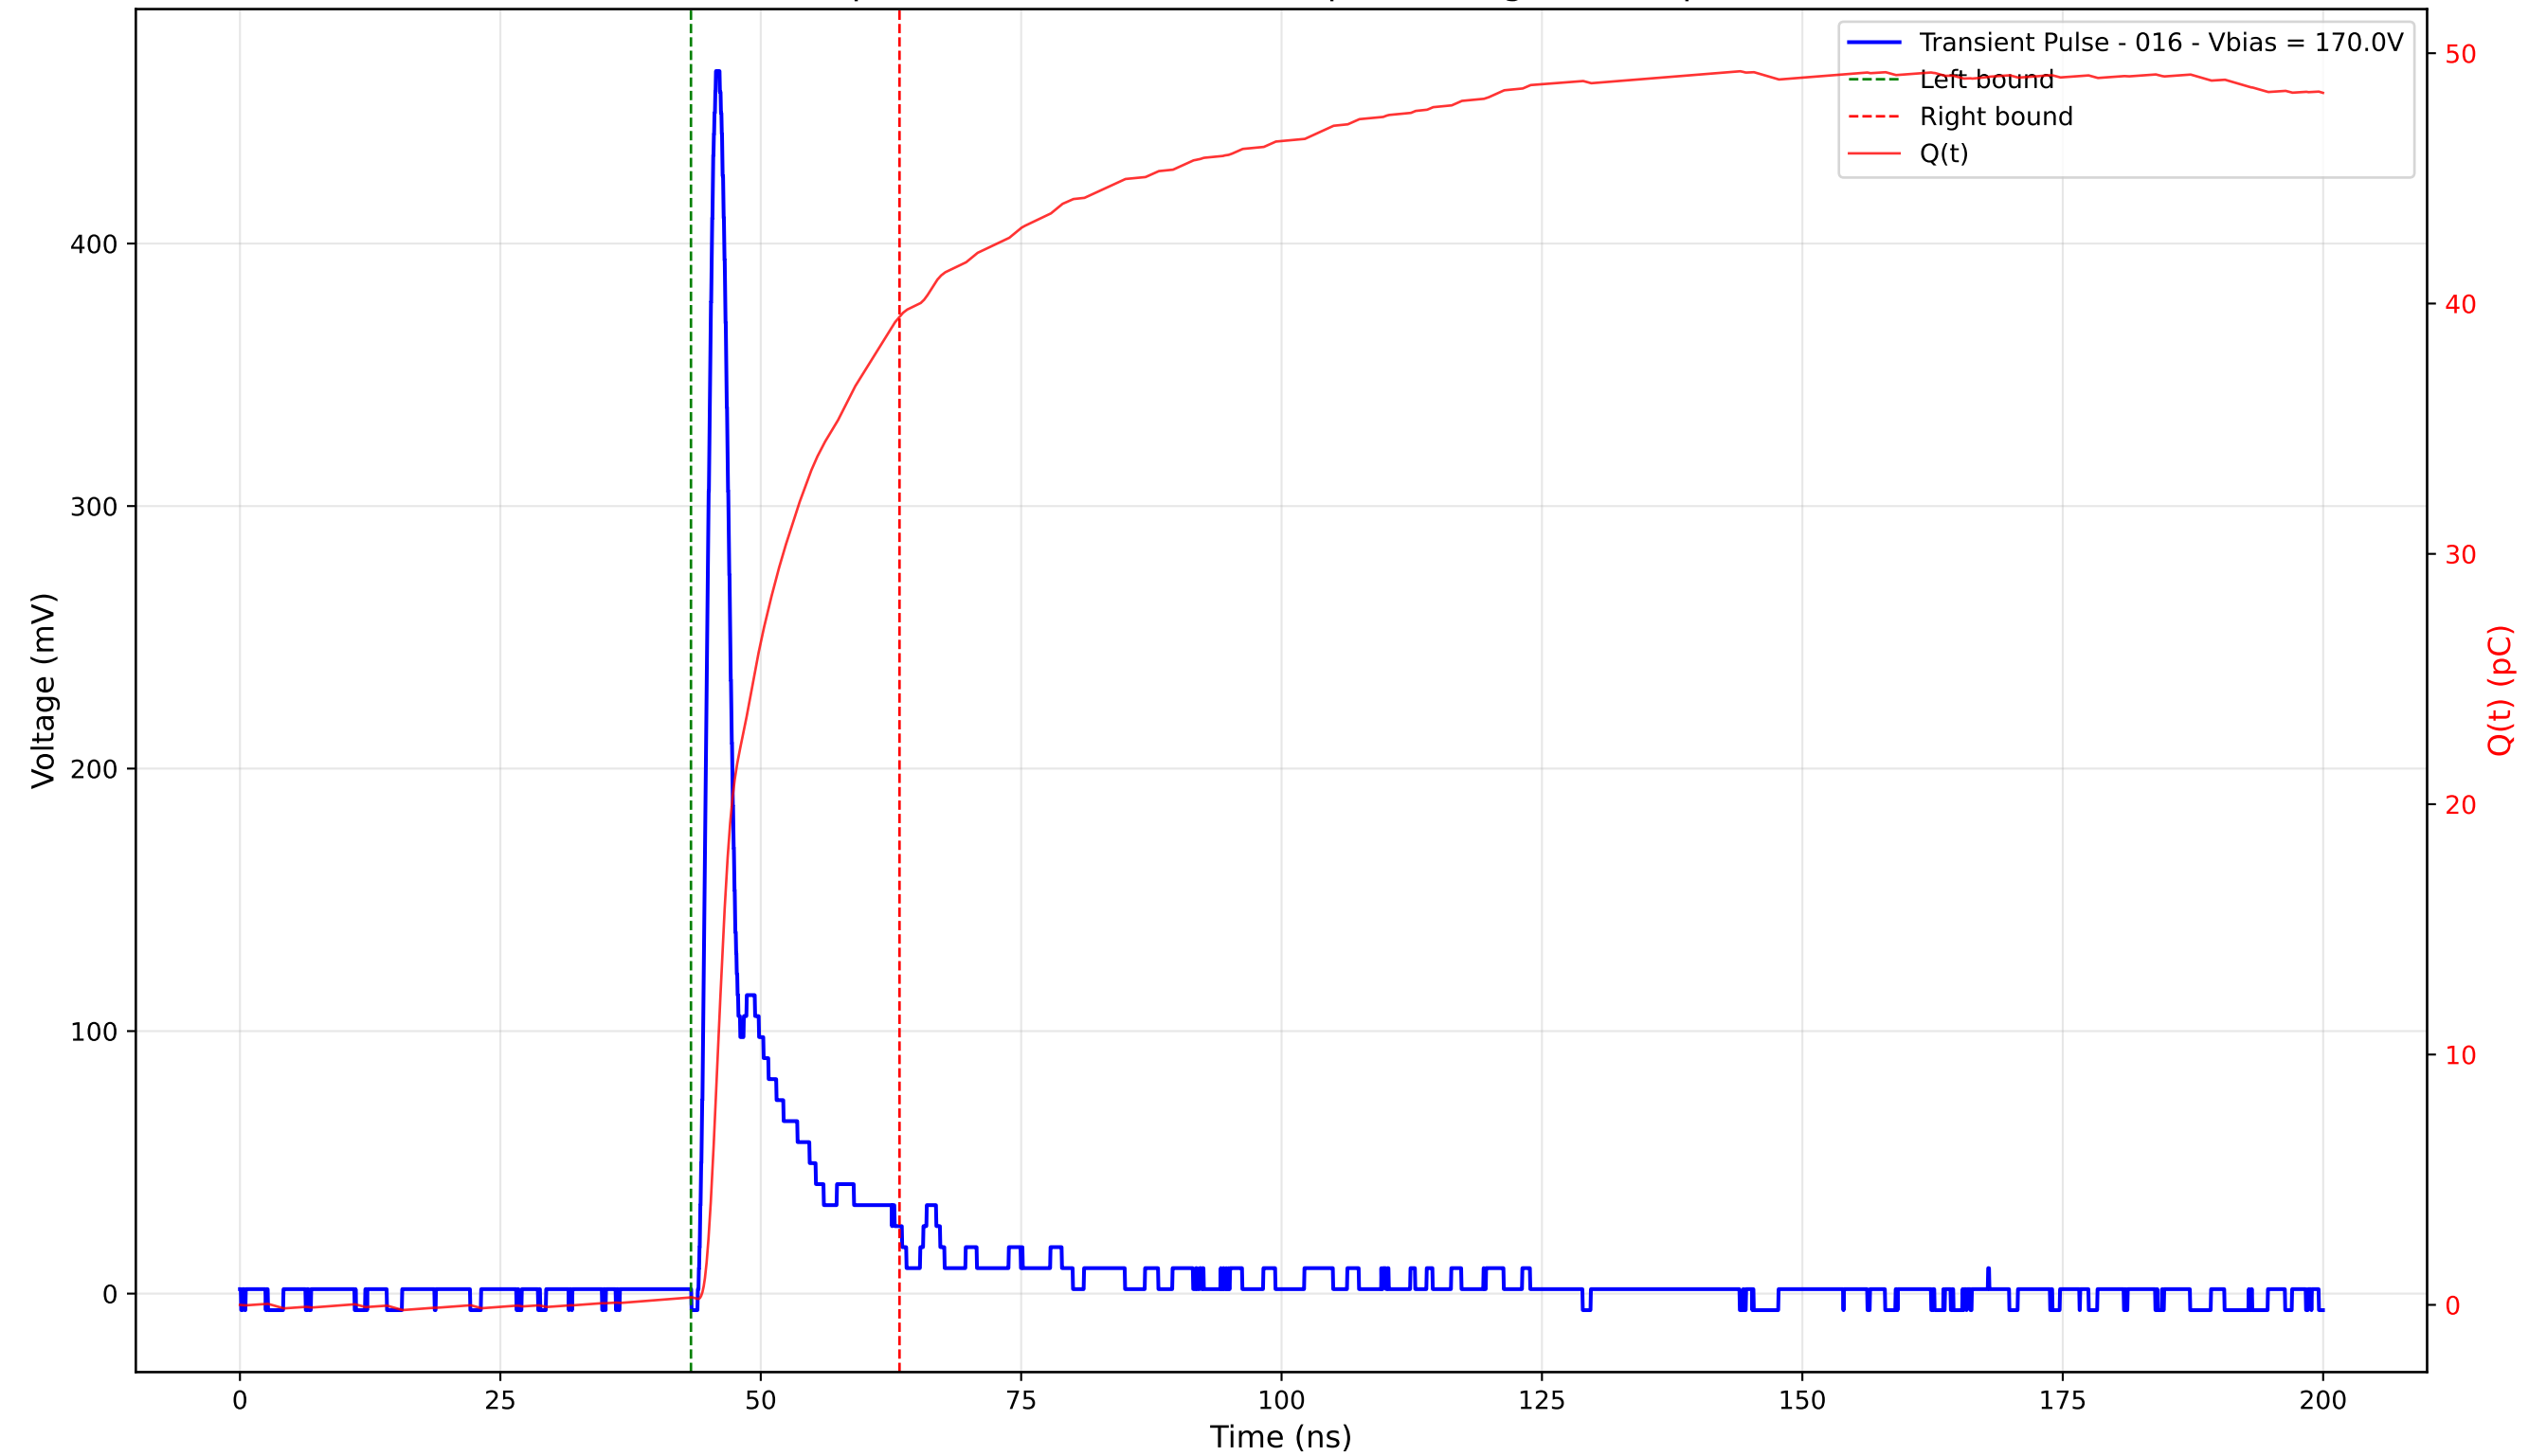


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 38.91 pC - Rise Time: 1.15 ns

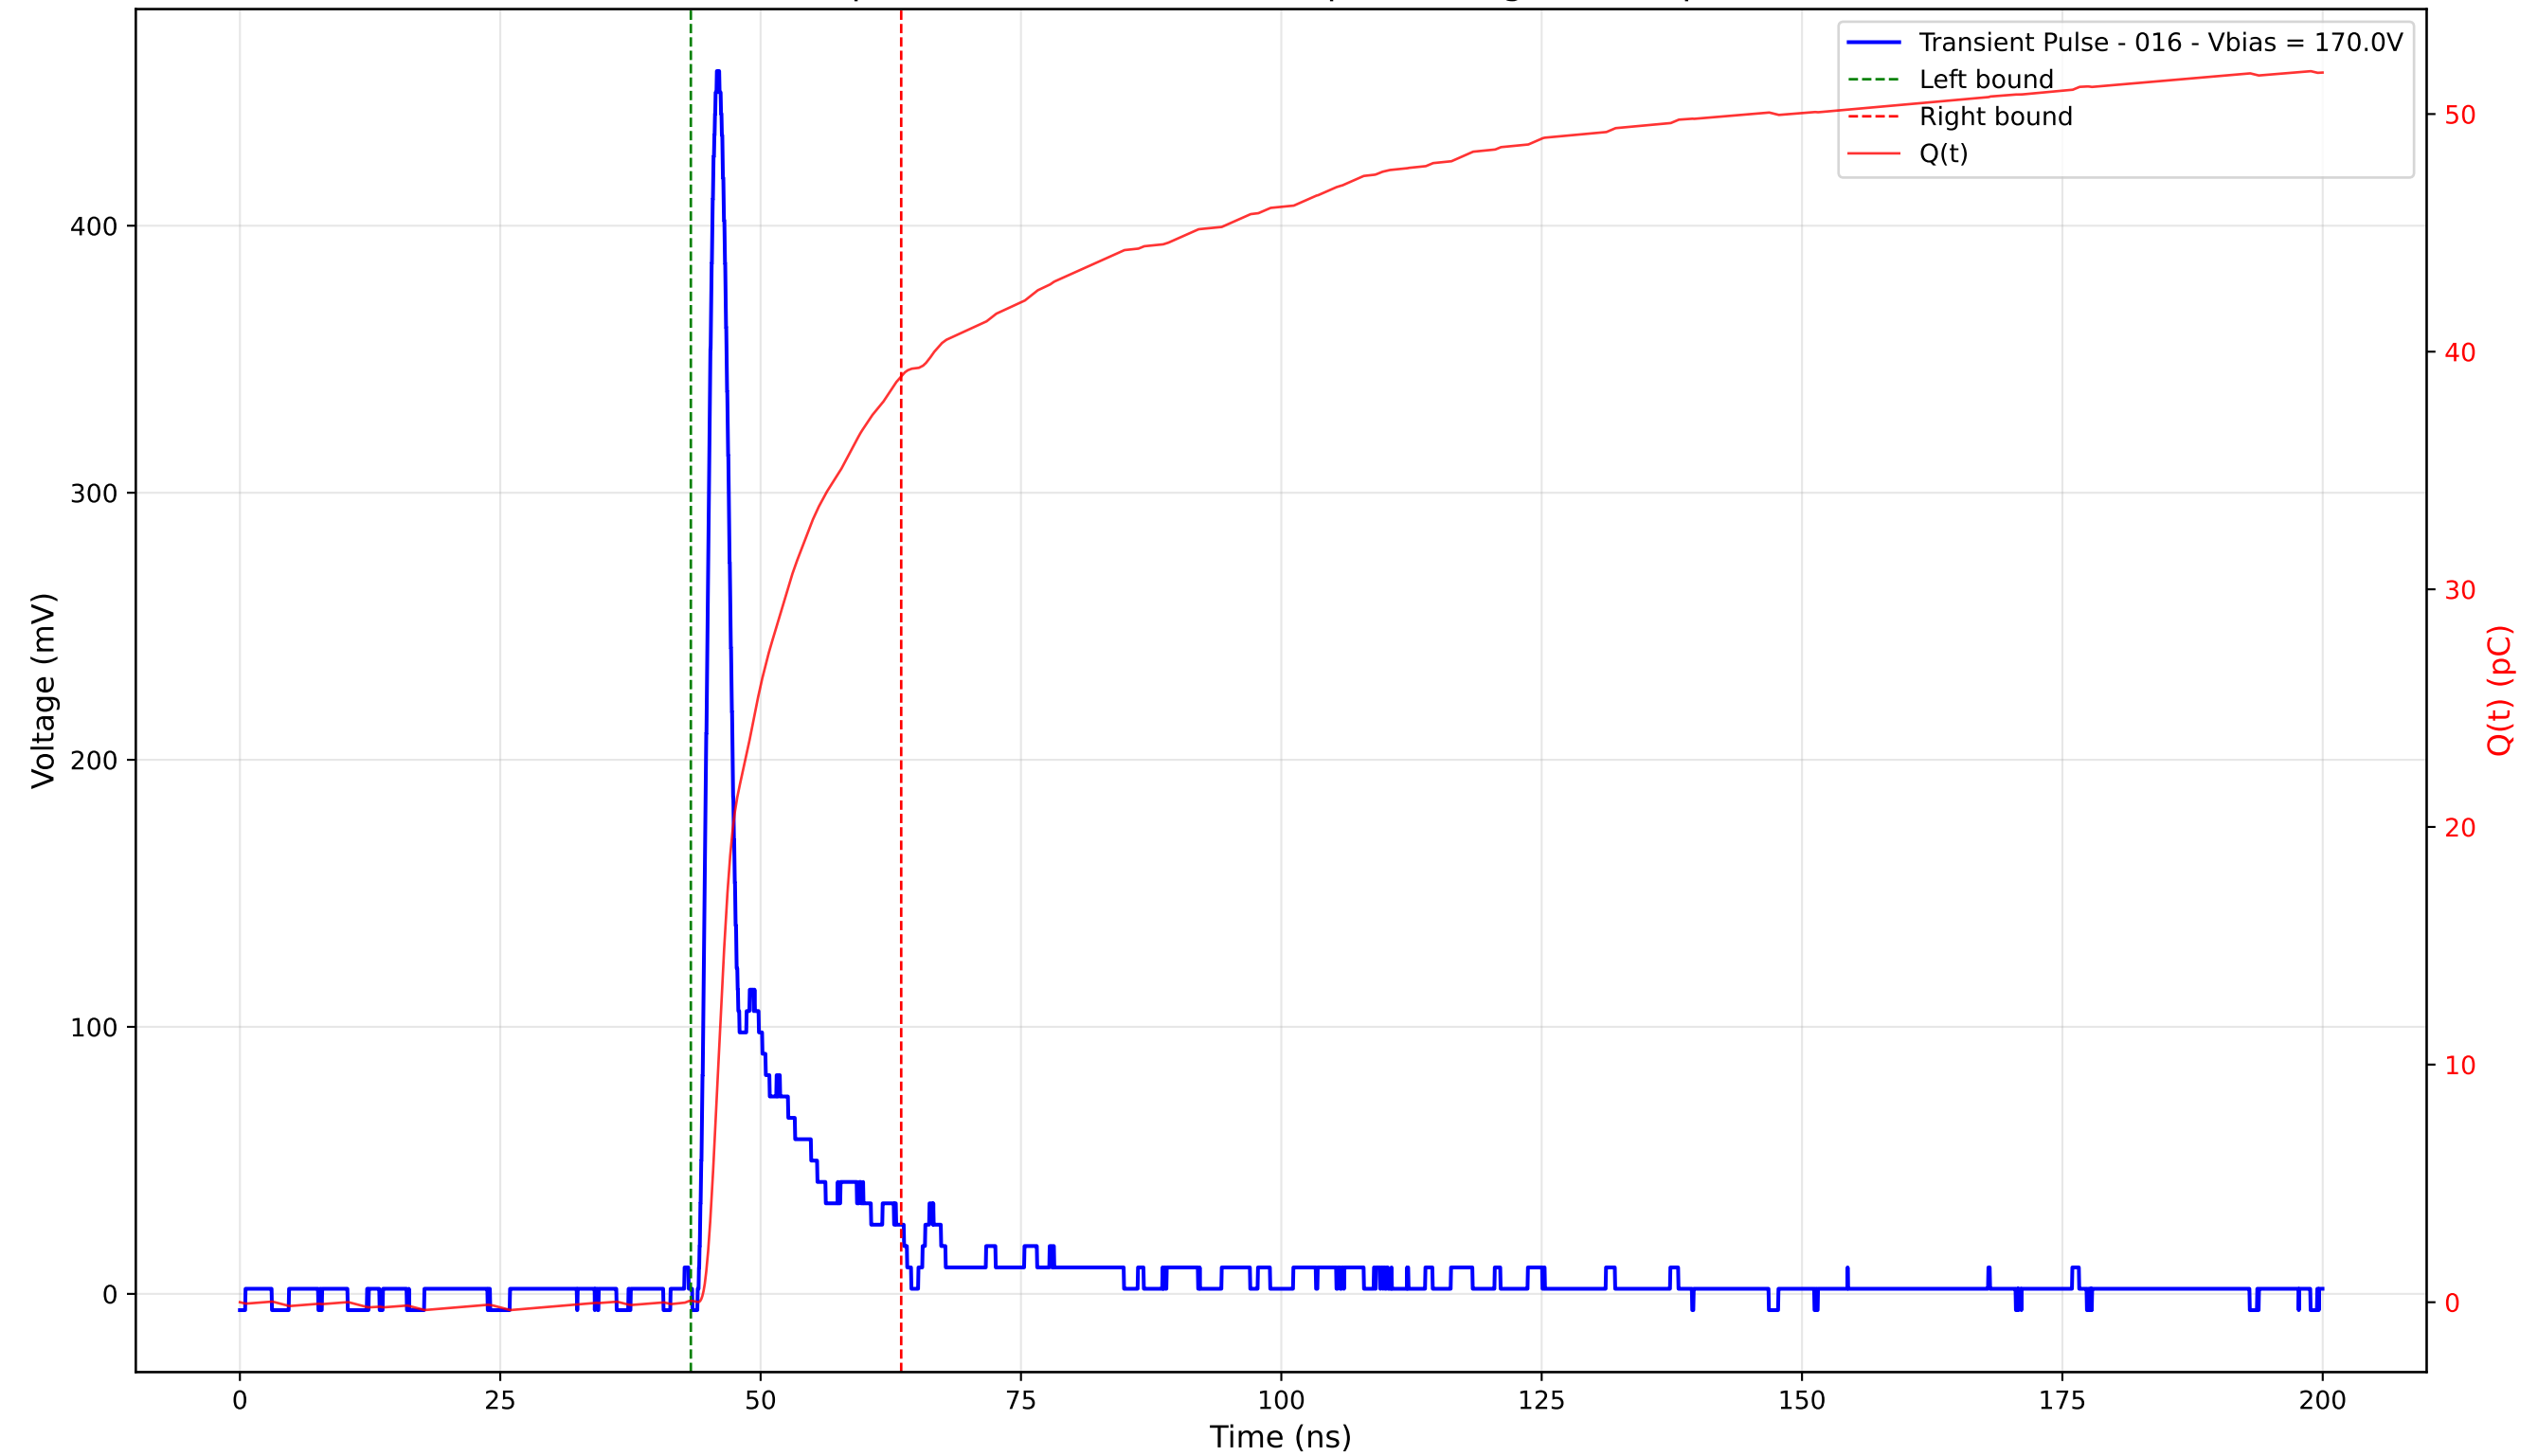


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 39.20 pC - Rise Time: 1.15 ns

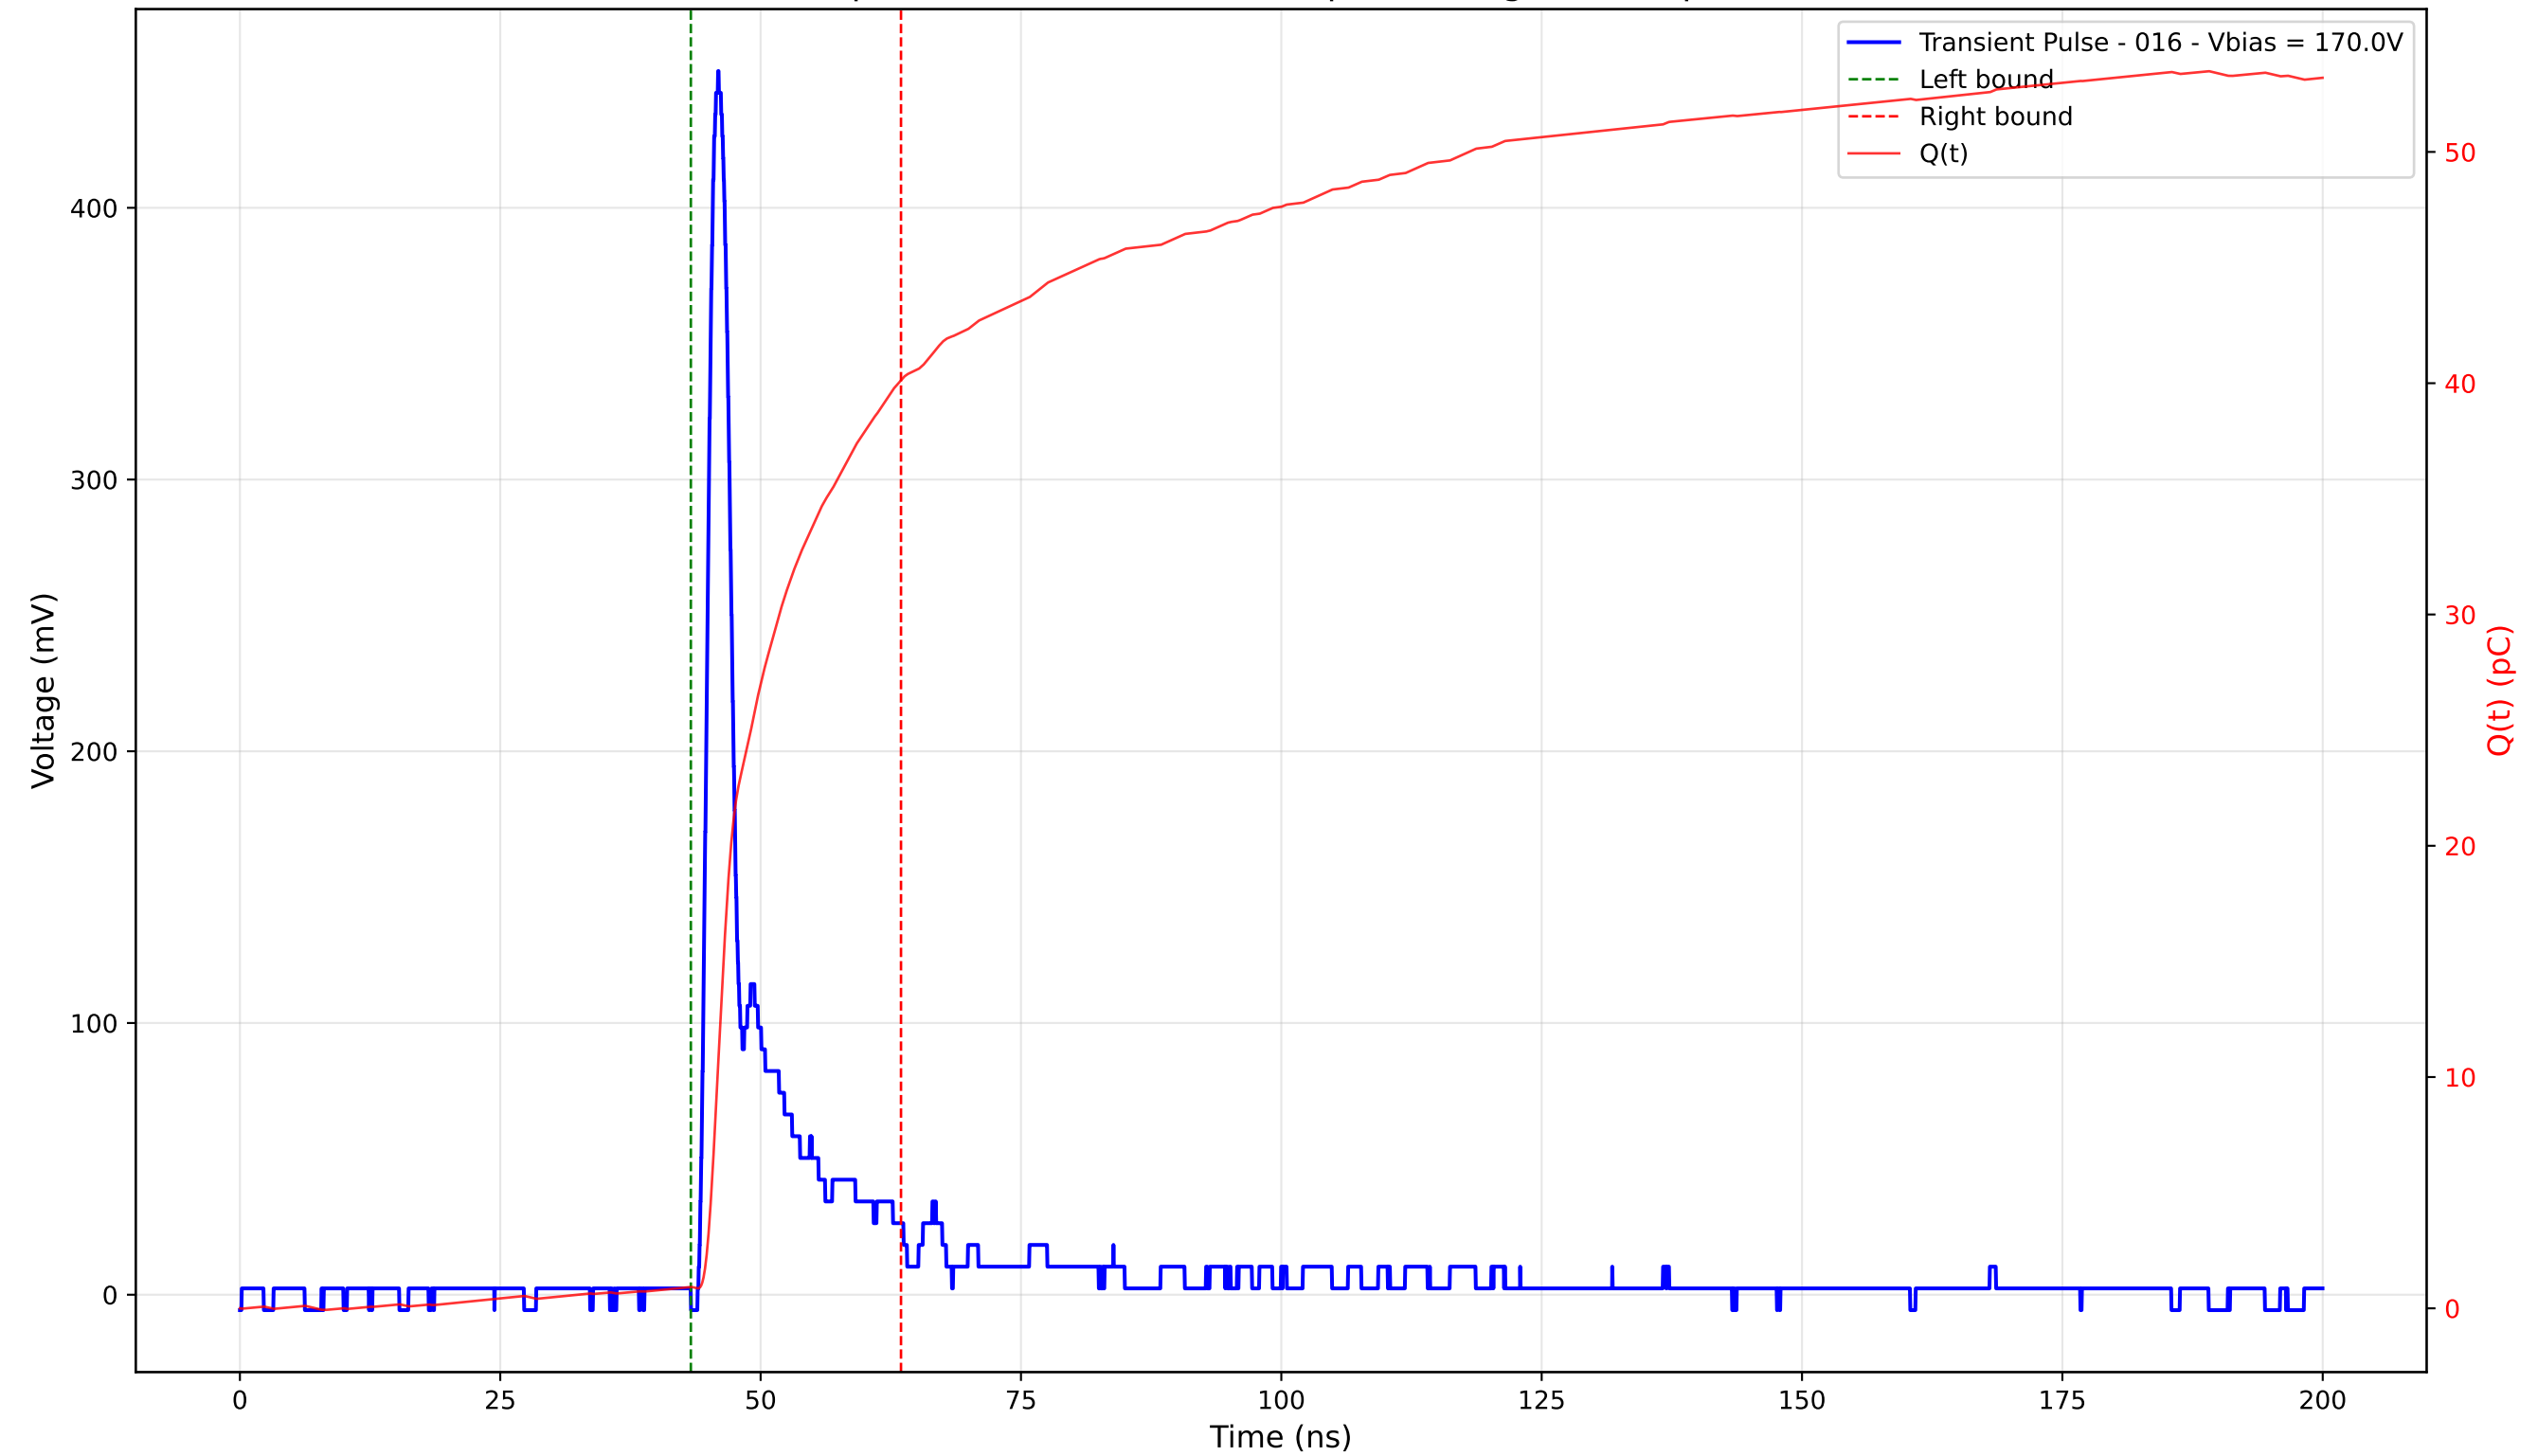


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 38.14 pC - Rise Time: 1.14 ns

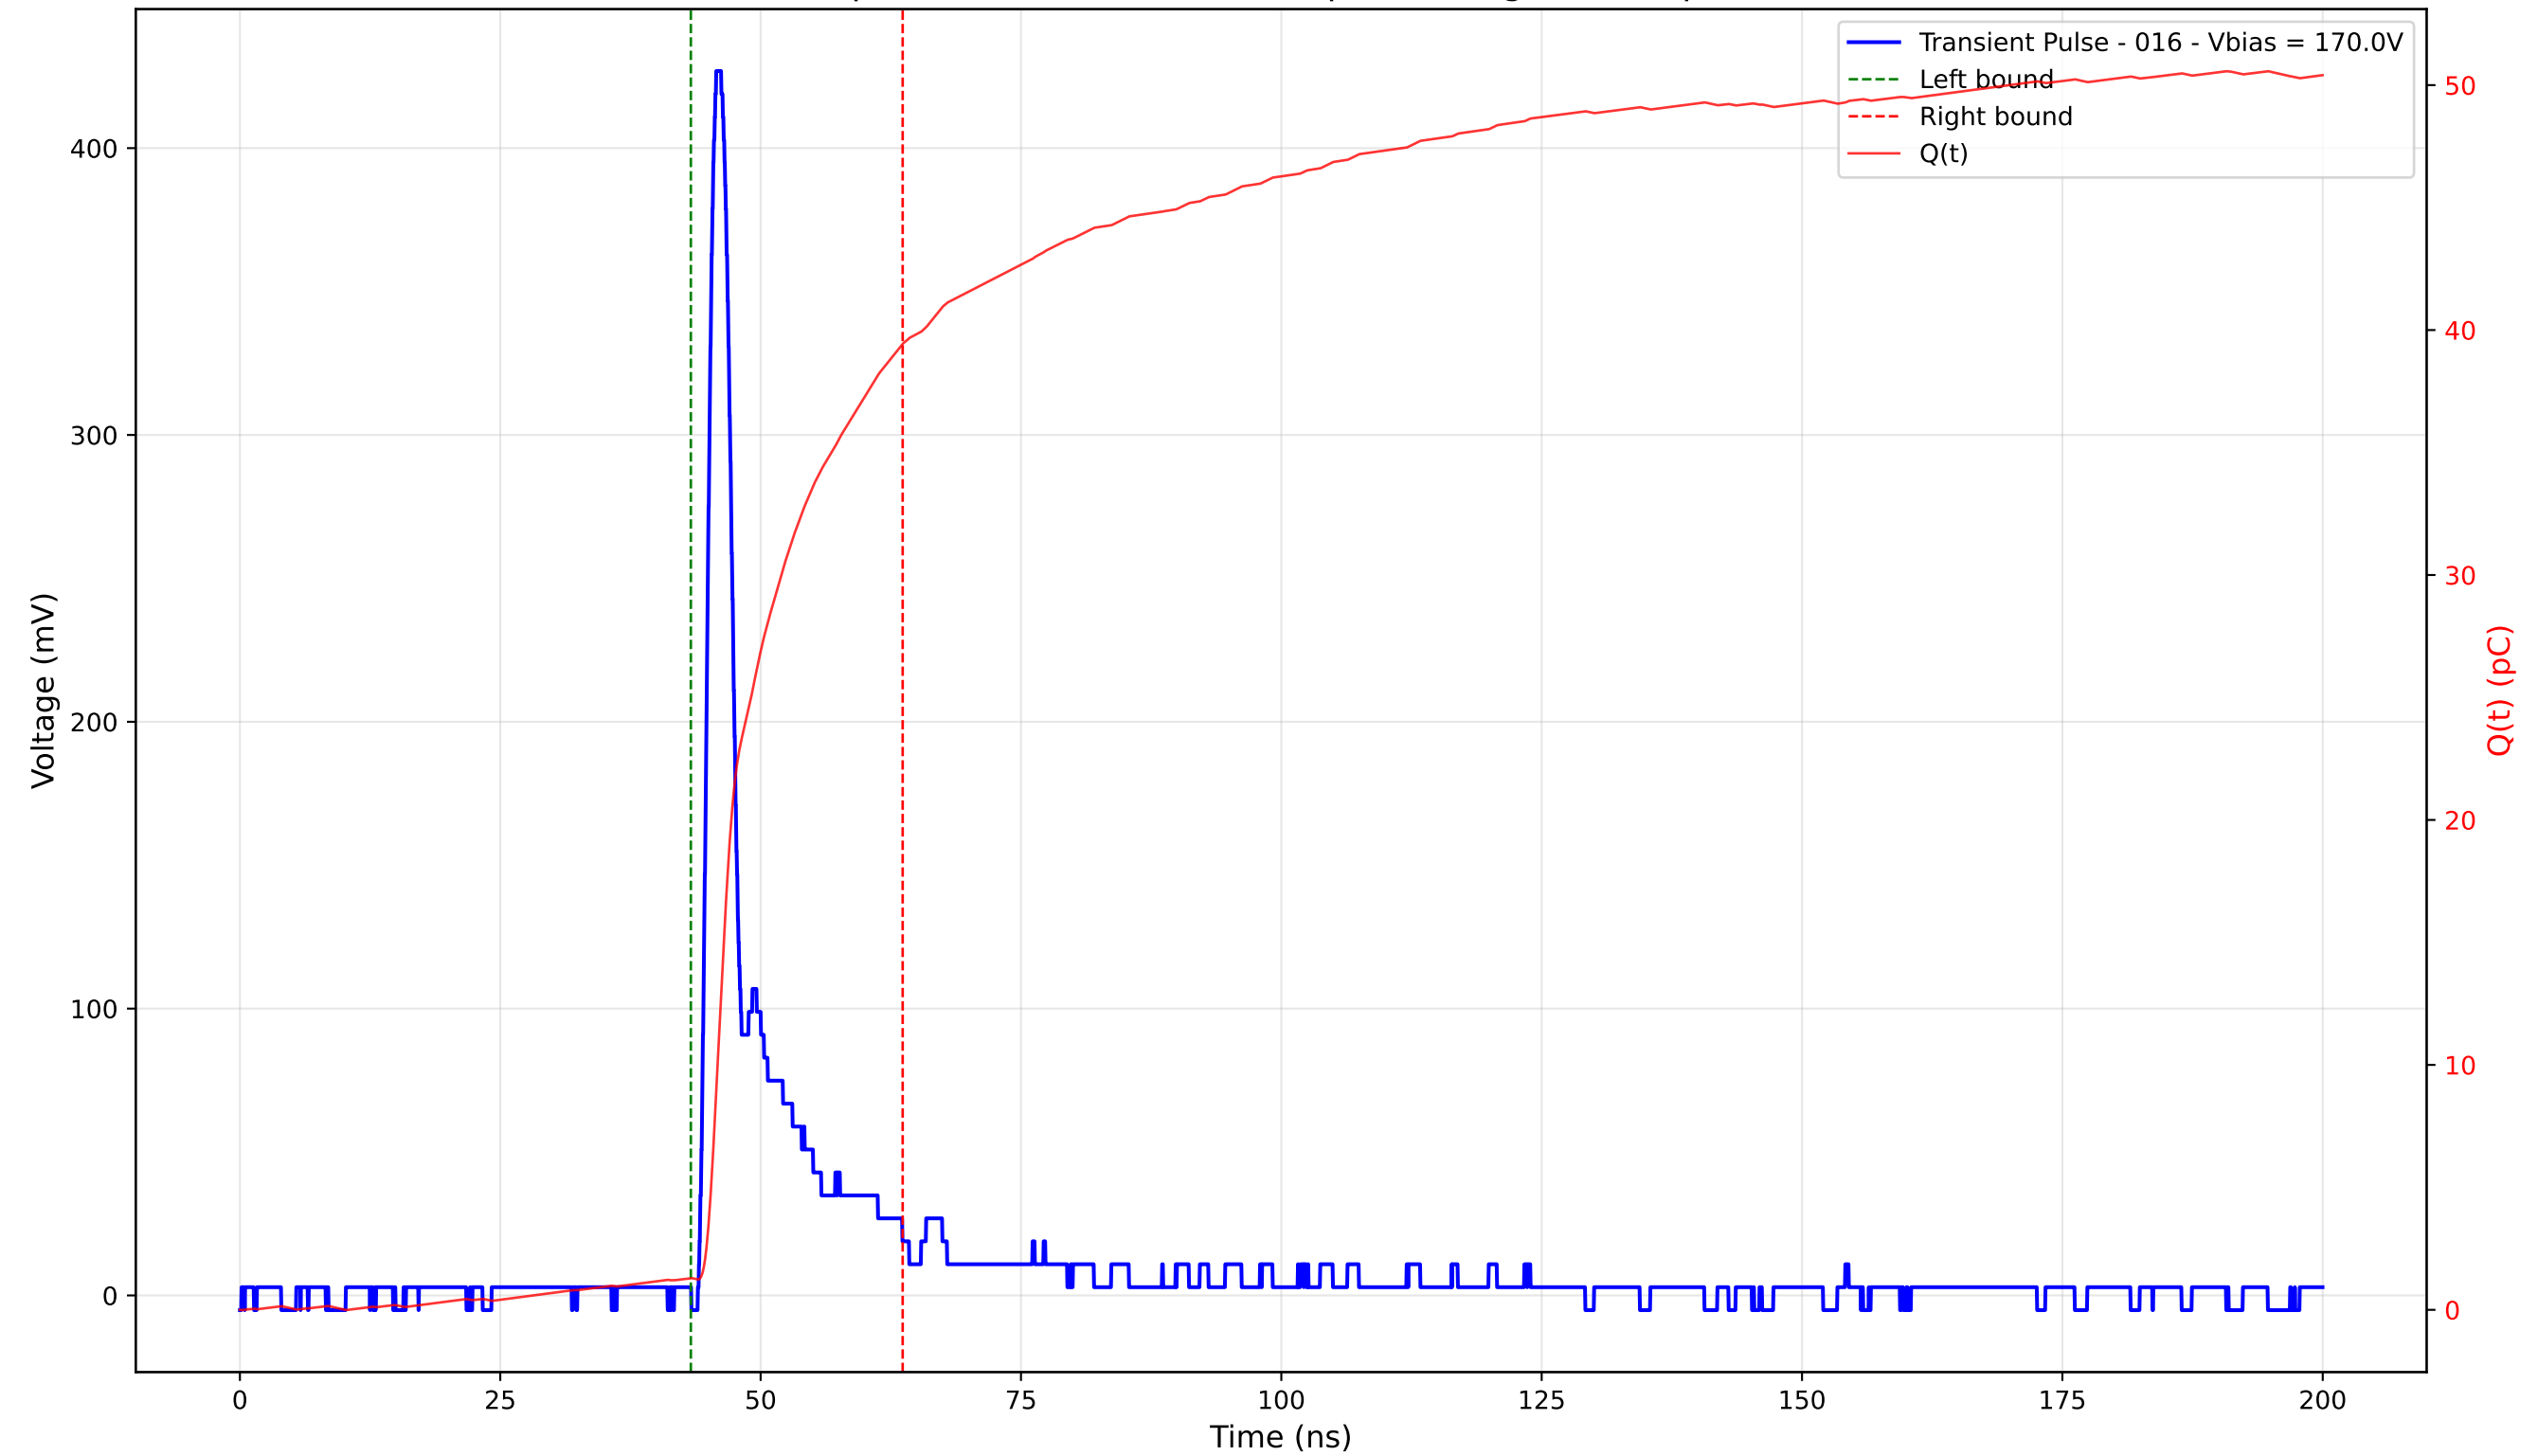


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 38.16 pC - Rise Time: 1.14 ns

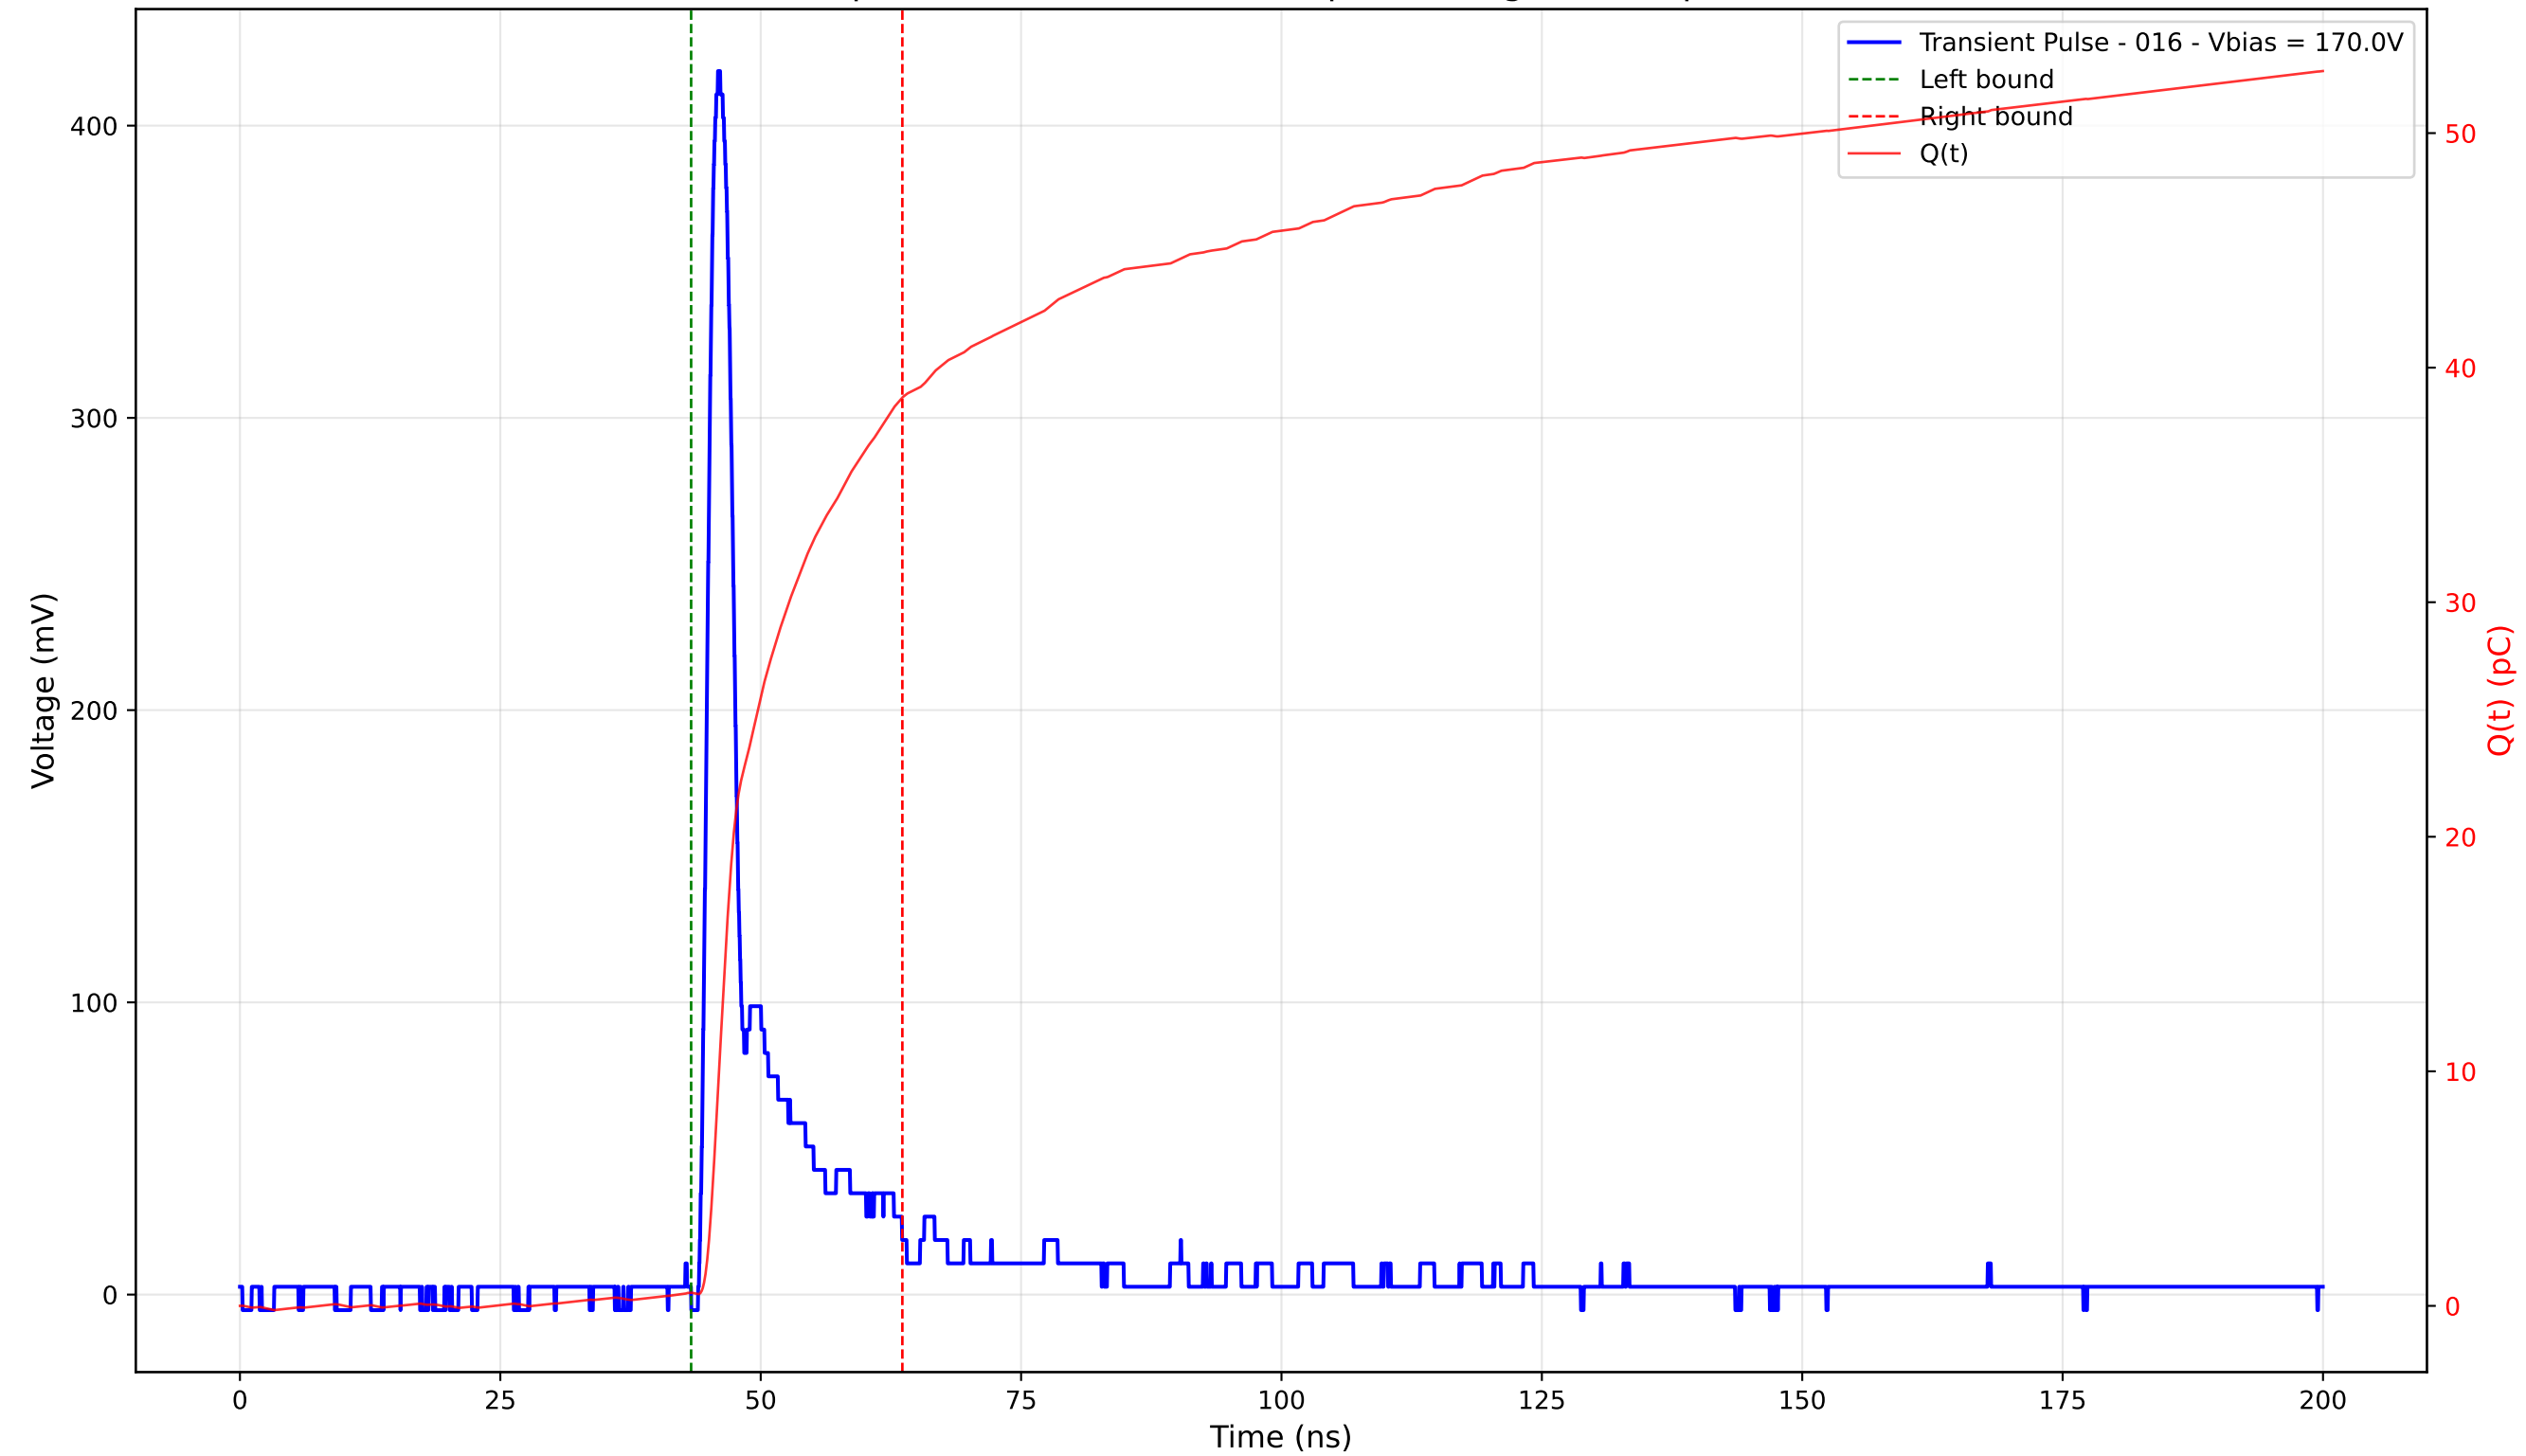


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 37.81 pC - Rise Time: 1.15 ns

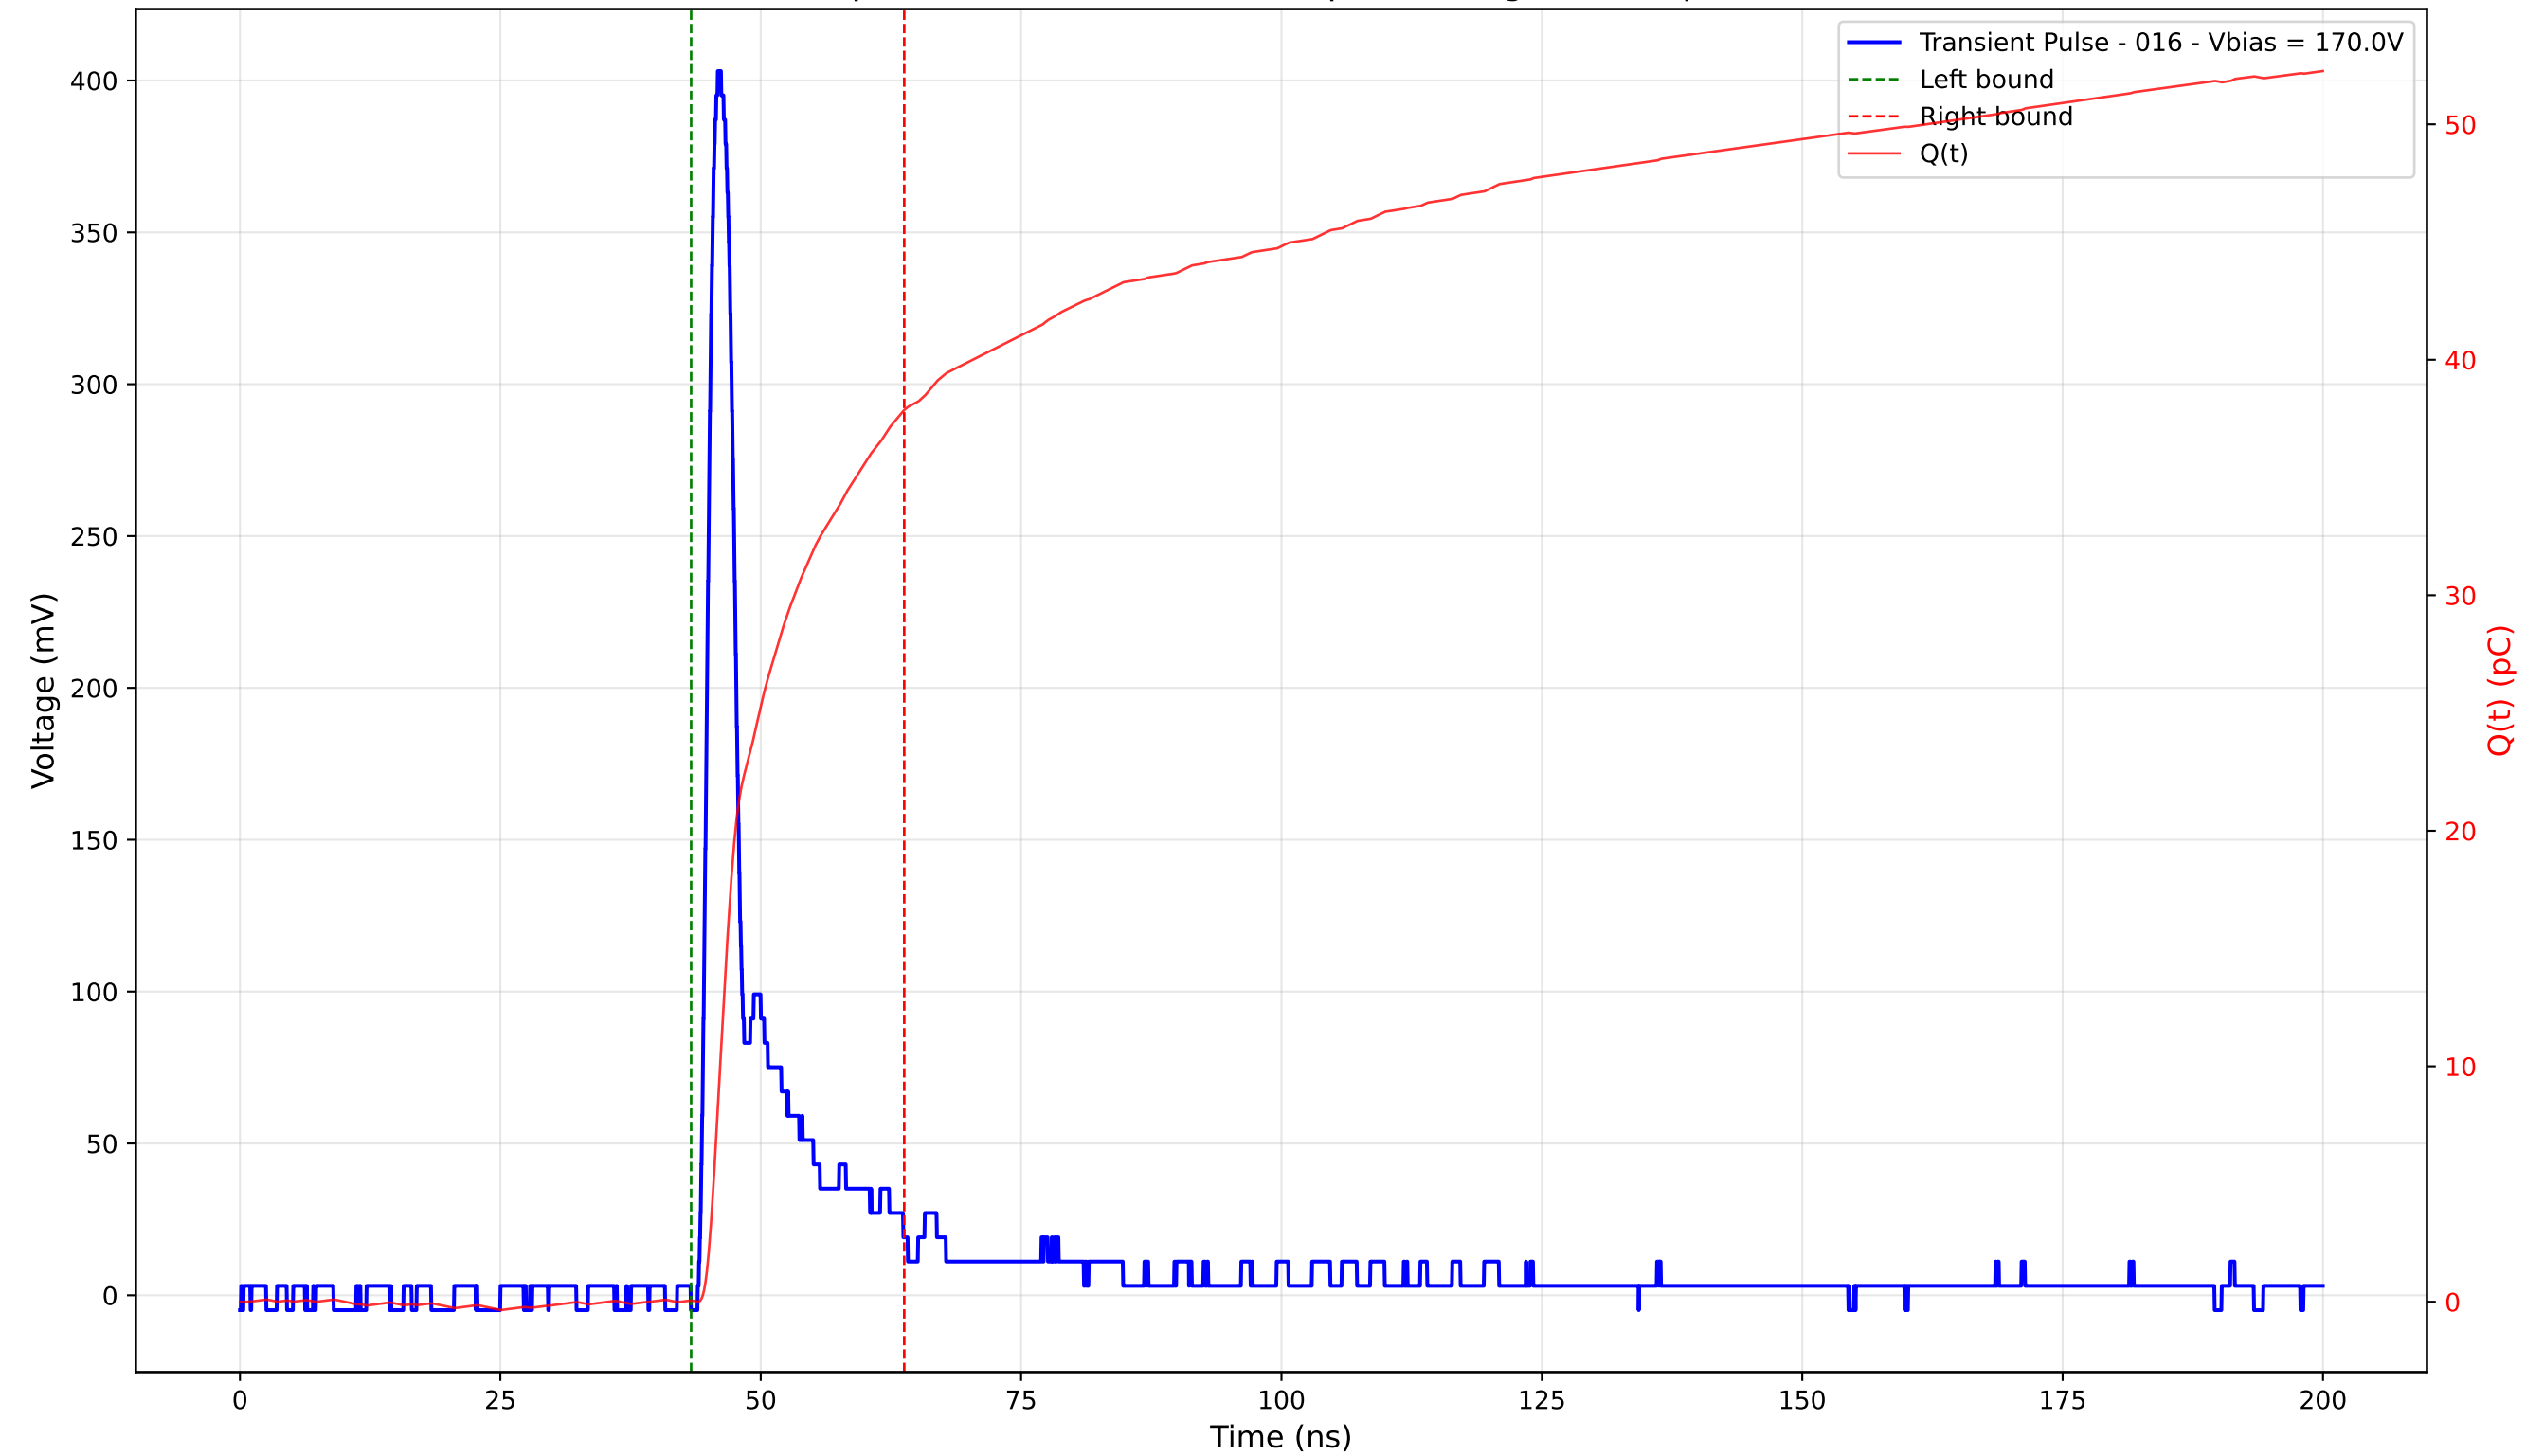


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 36.75 pC - Rise Time: 1.17 ns

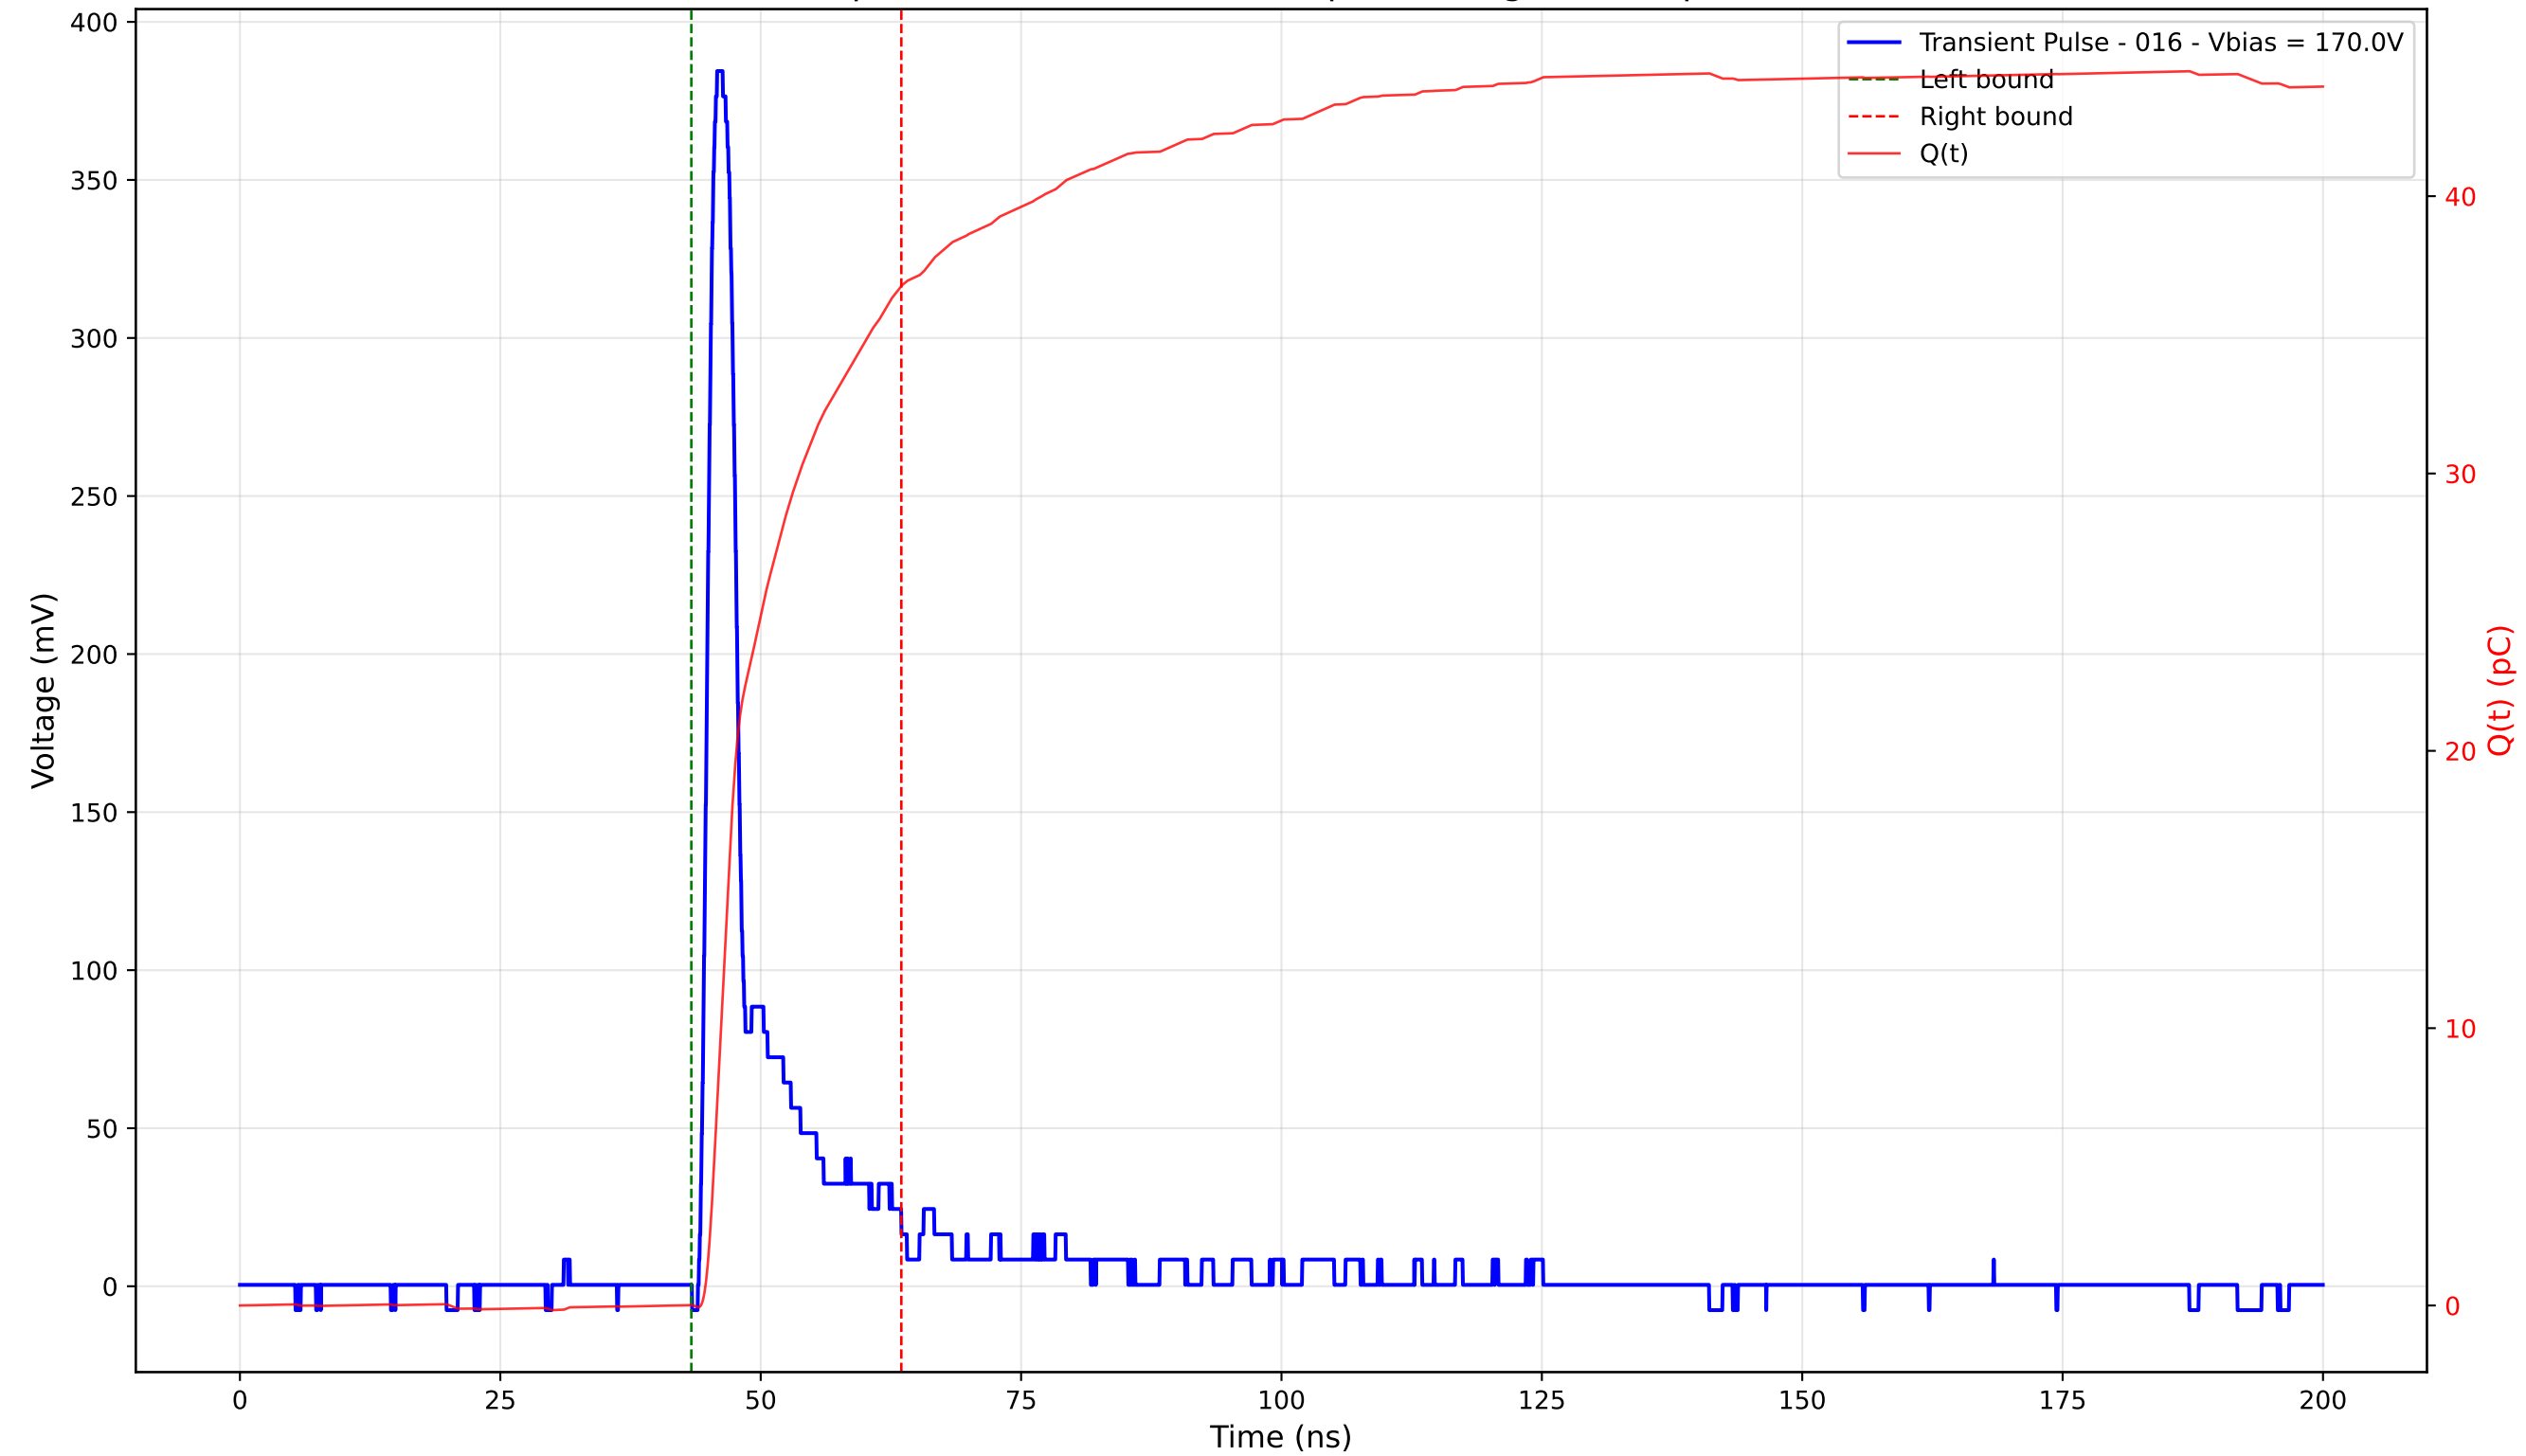


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 37.73 pC - Rise Time: 1.21 ns

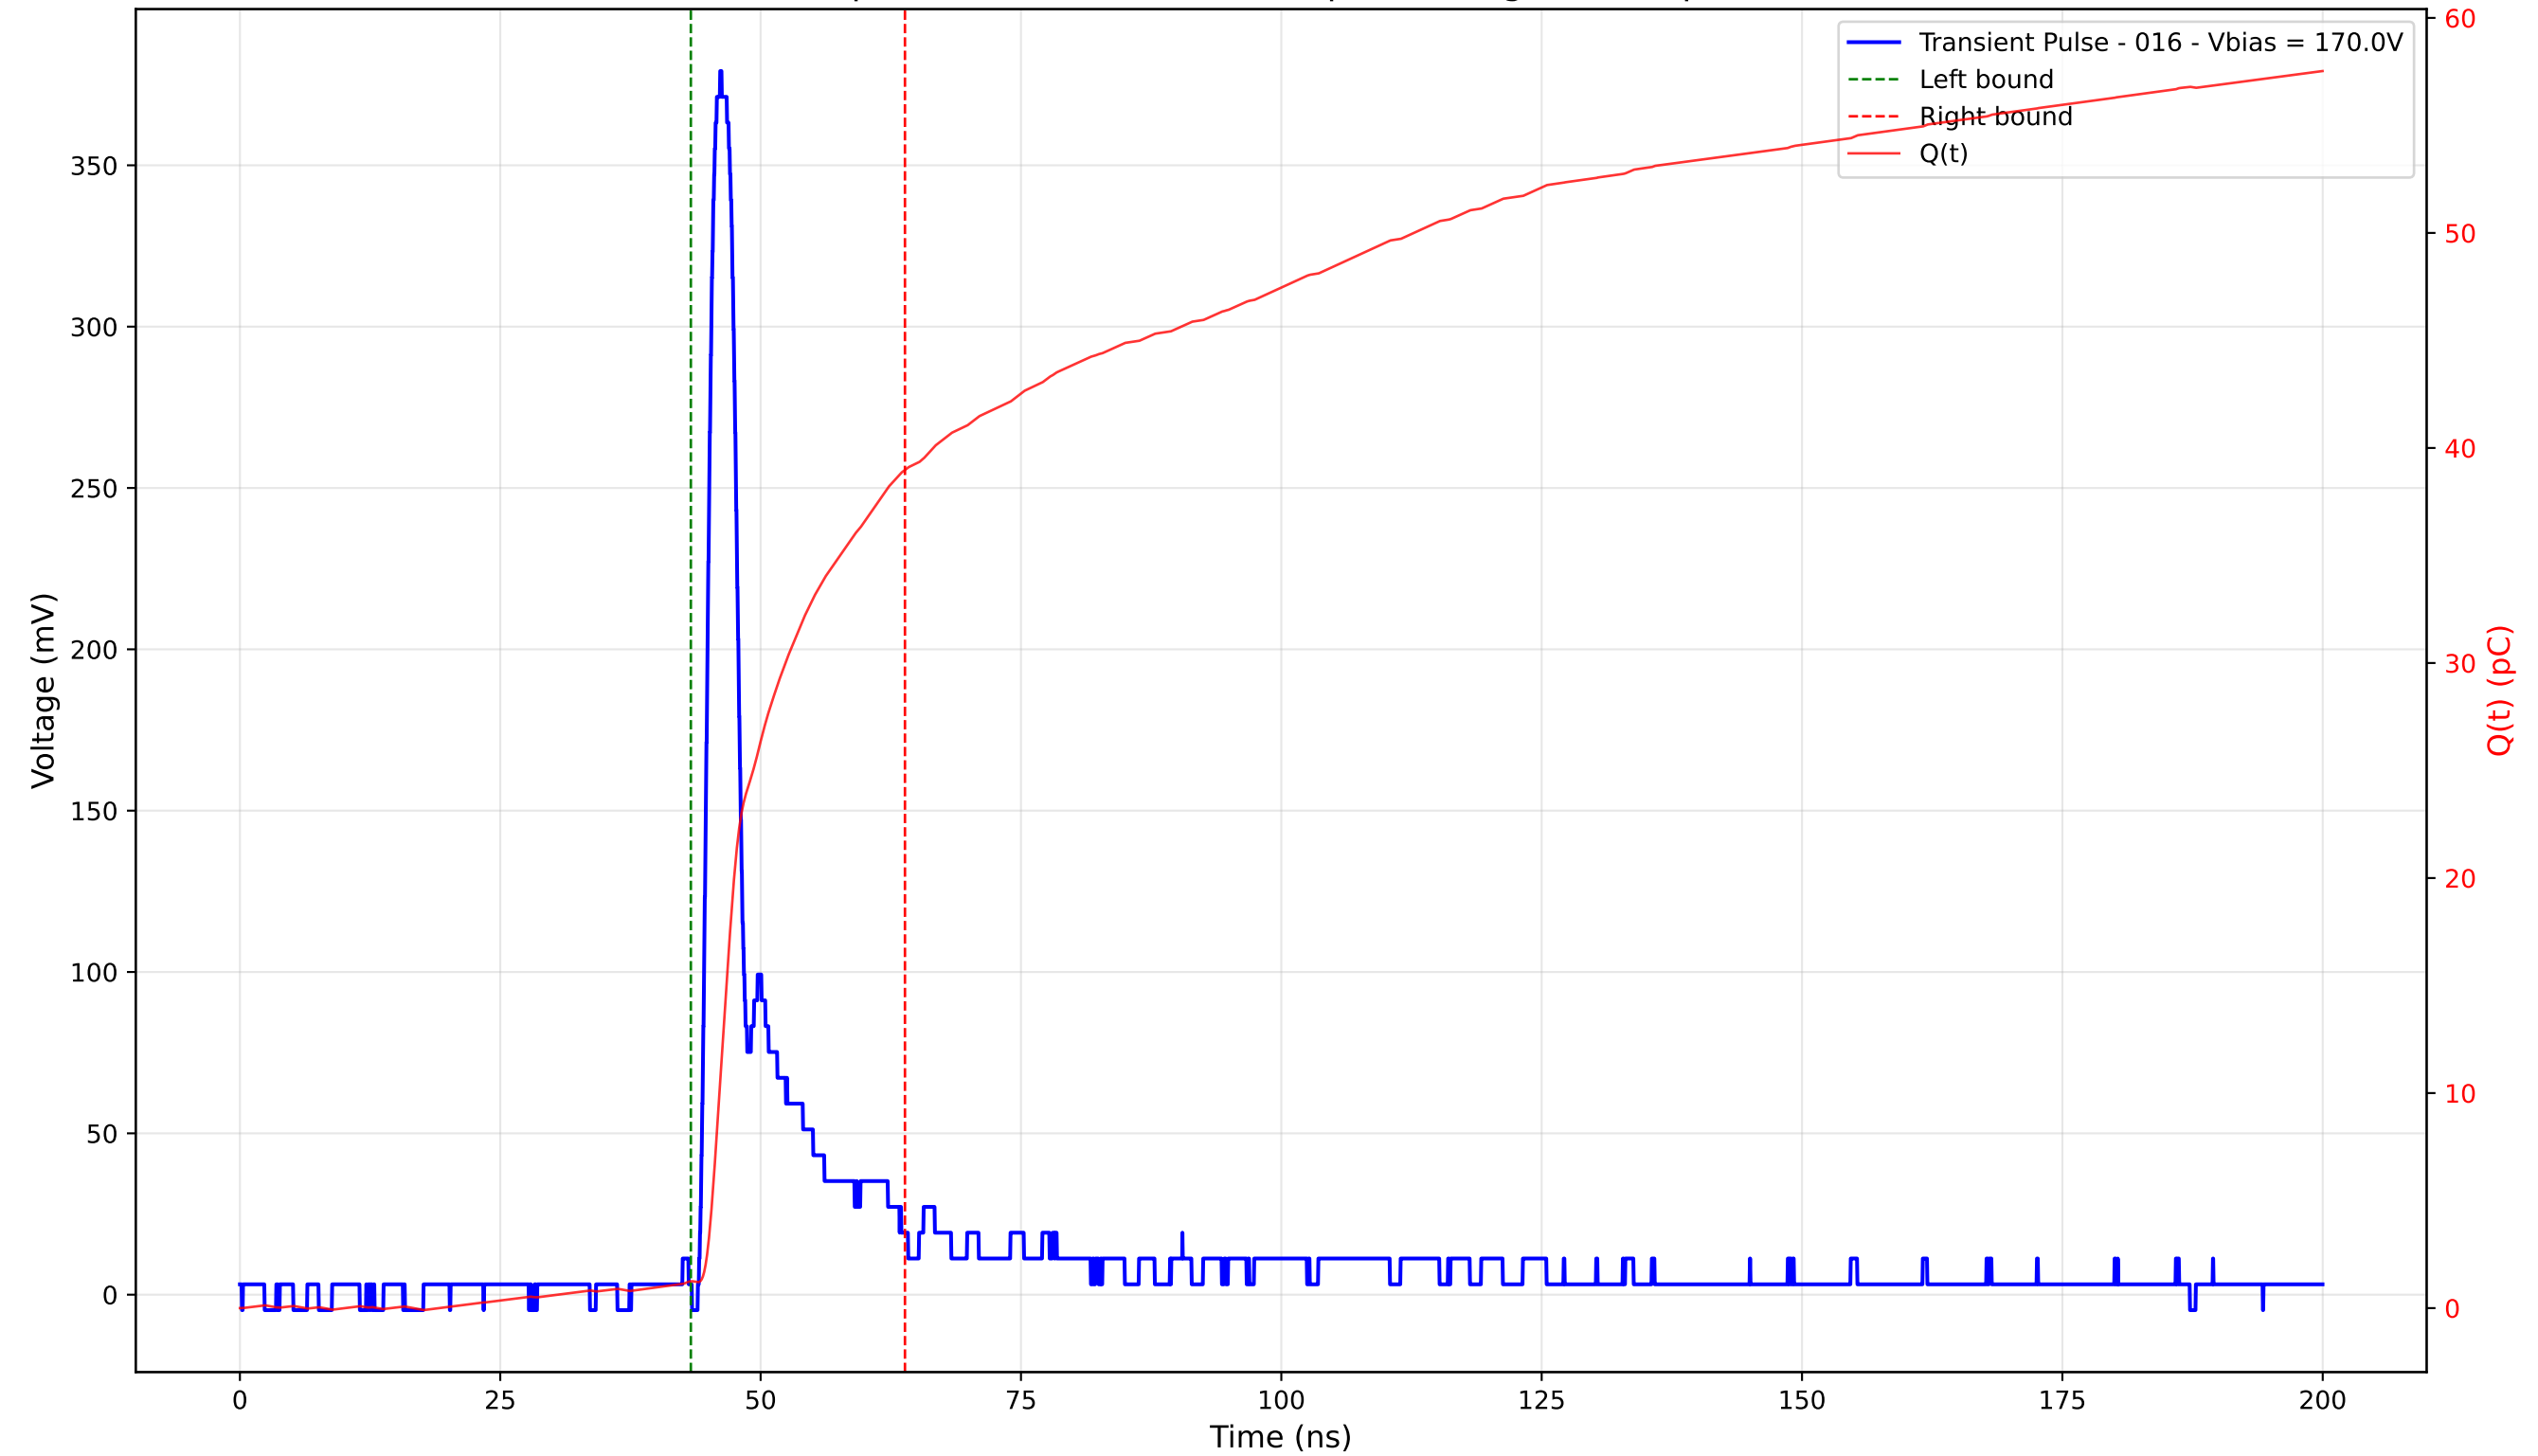


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 37.16 pC - Rise Time: 1.15 ns

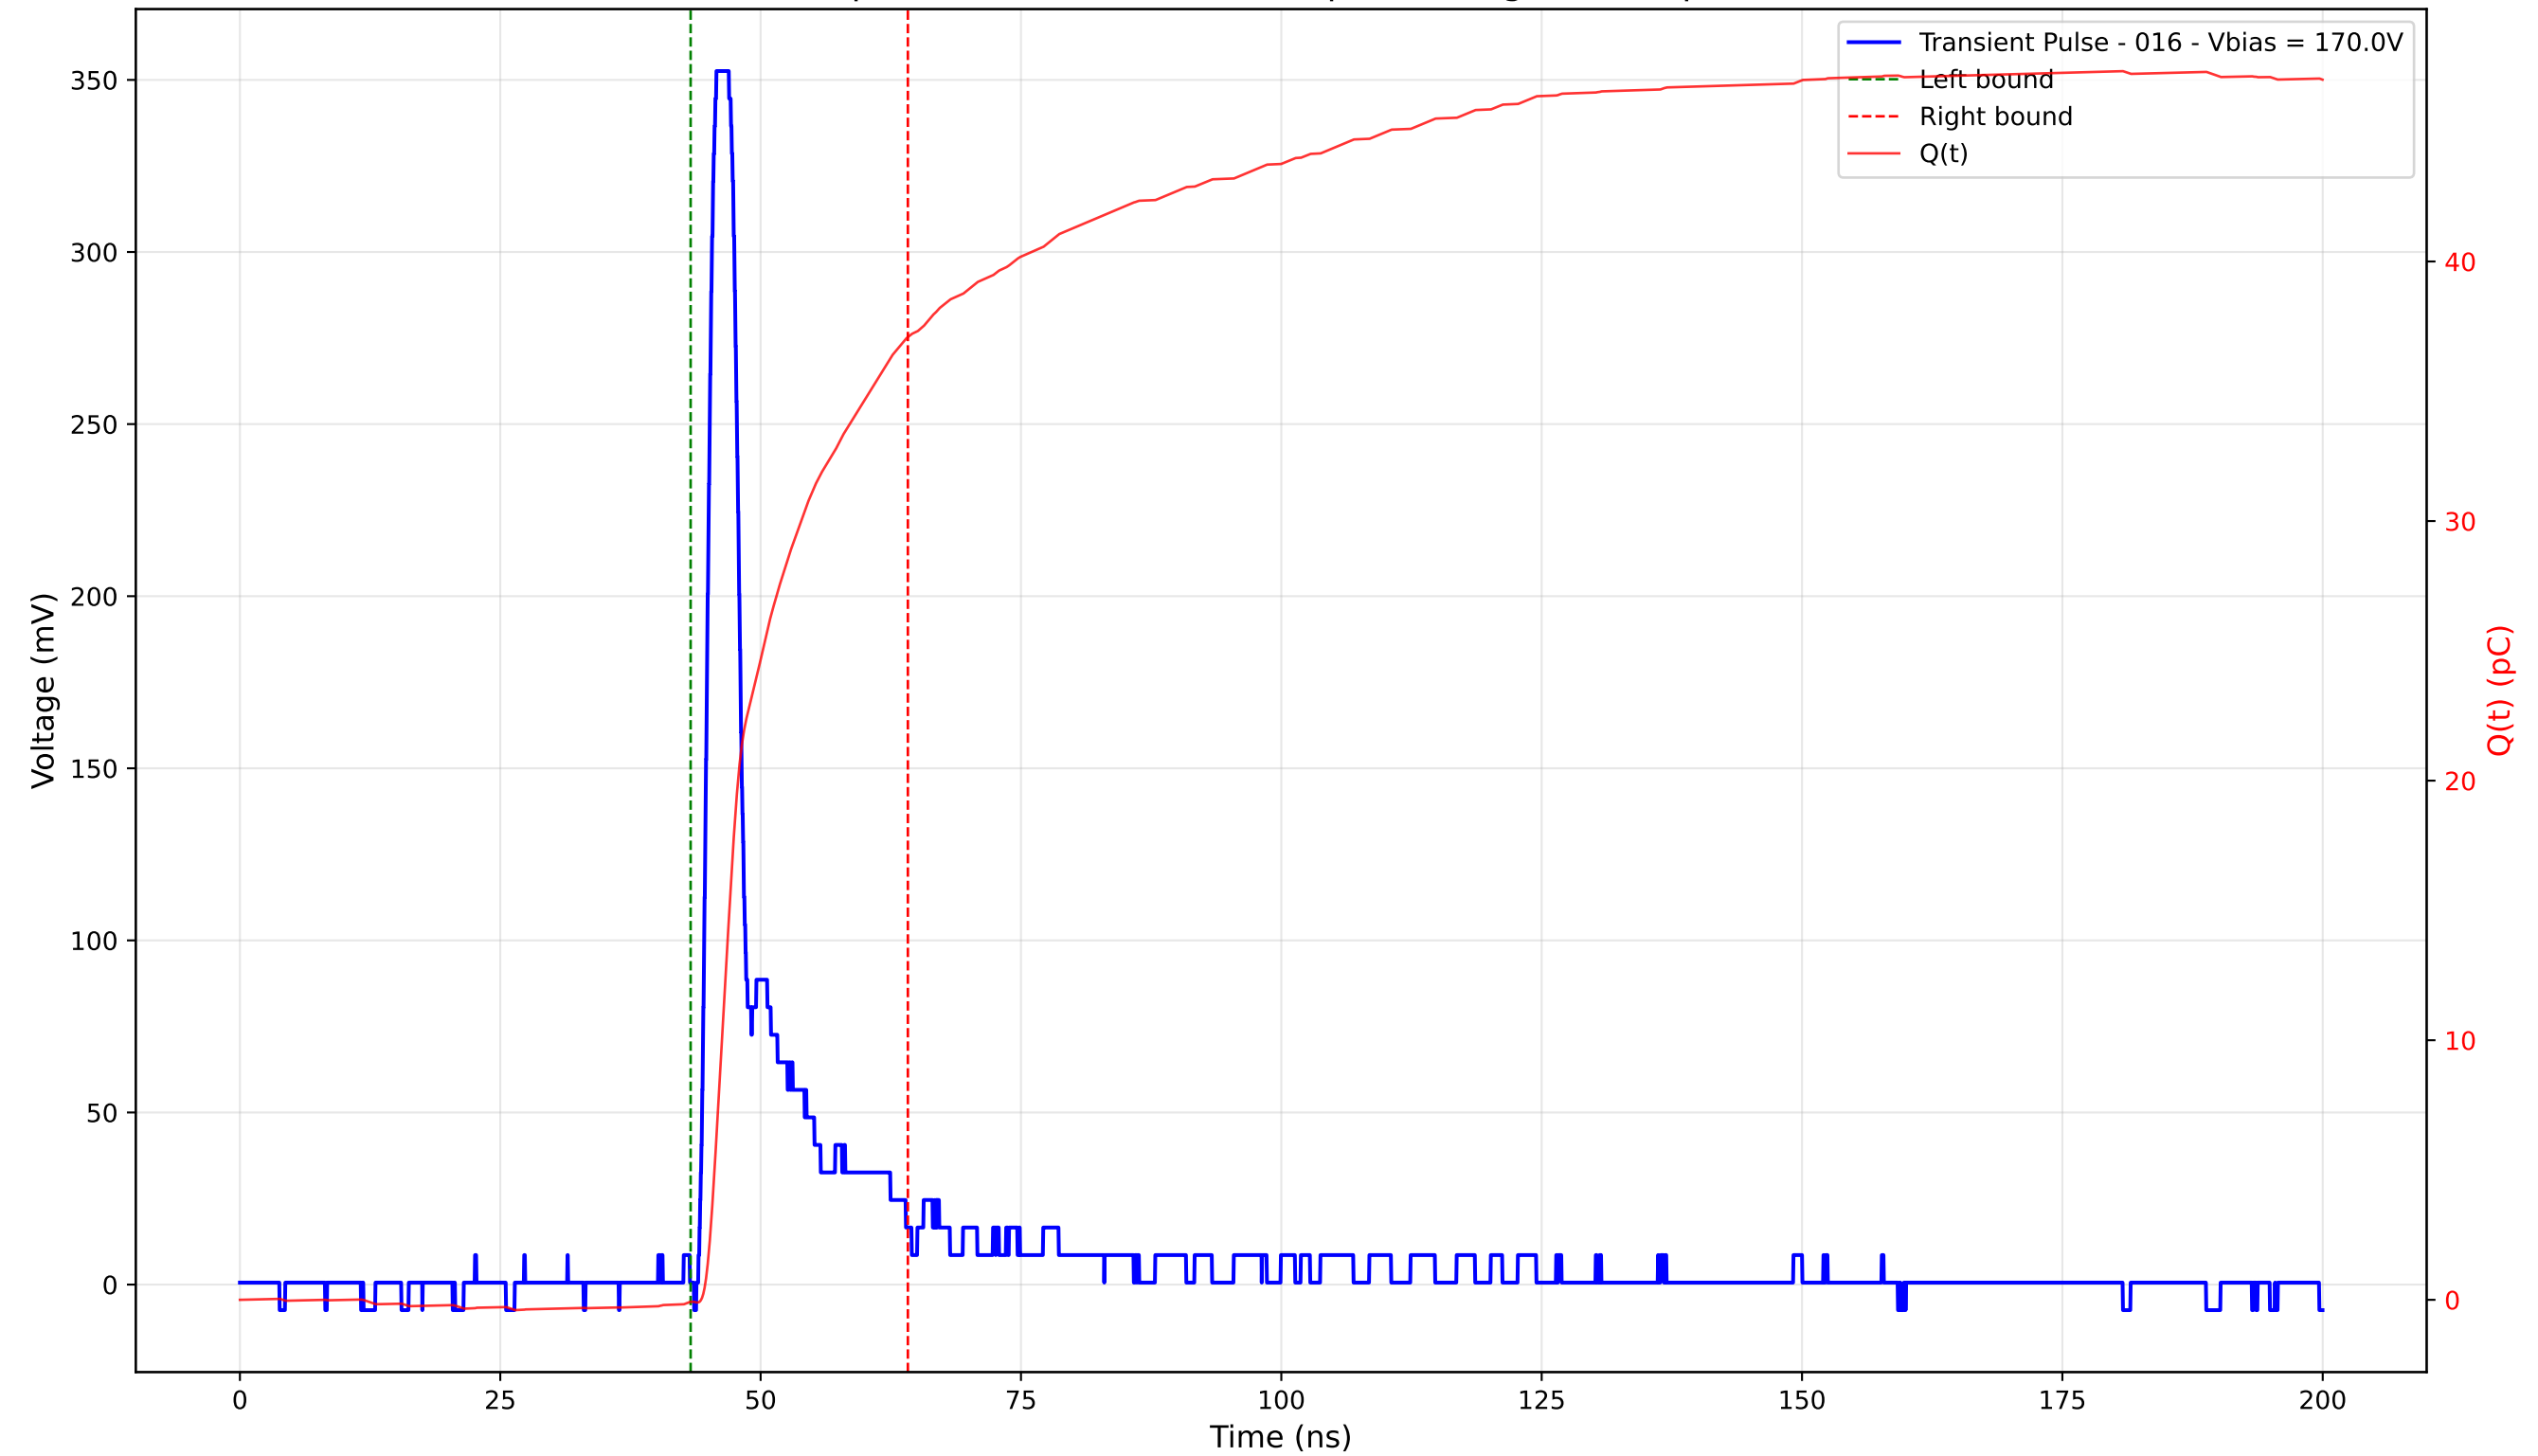


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 35.69 pC - Rise Time: 1.12 ns

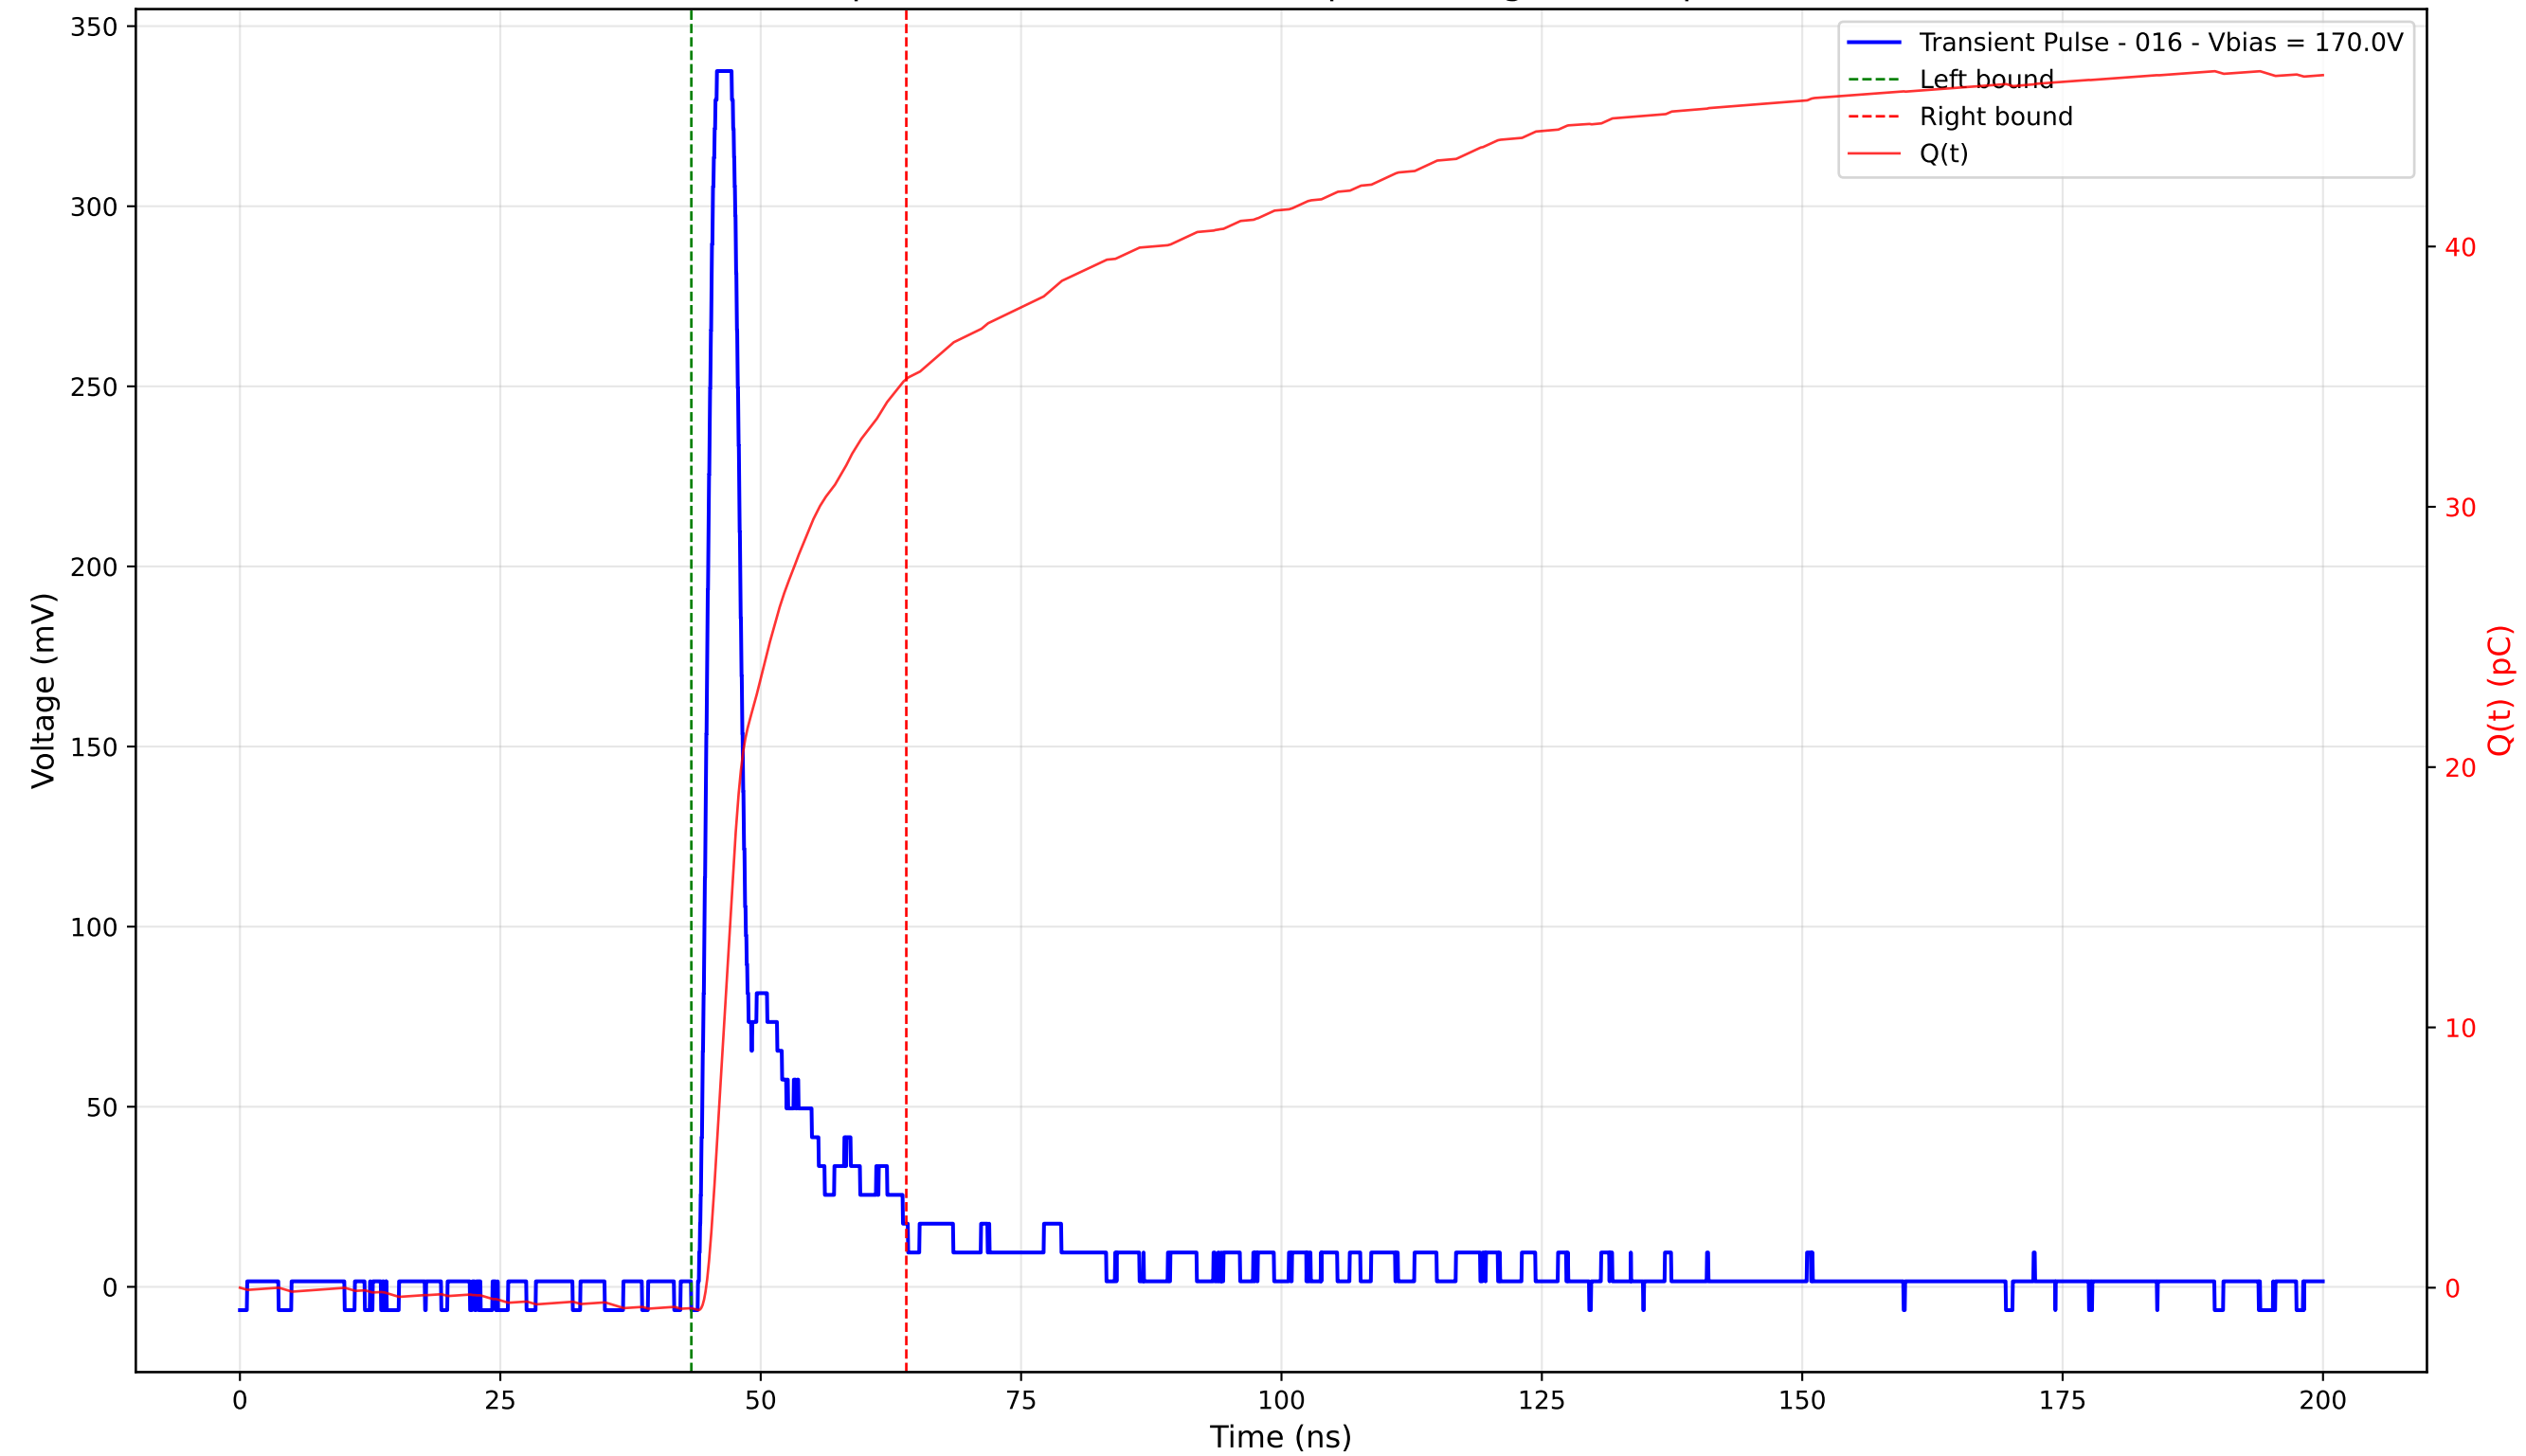


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 35.08 pC - Rise Time: 1.18 ns

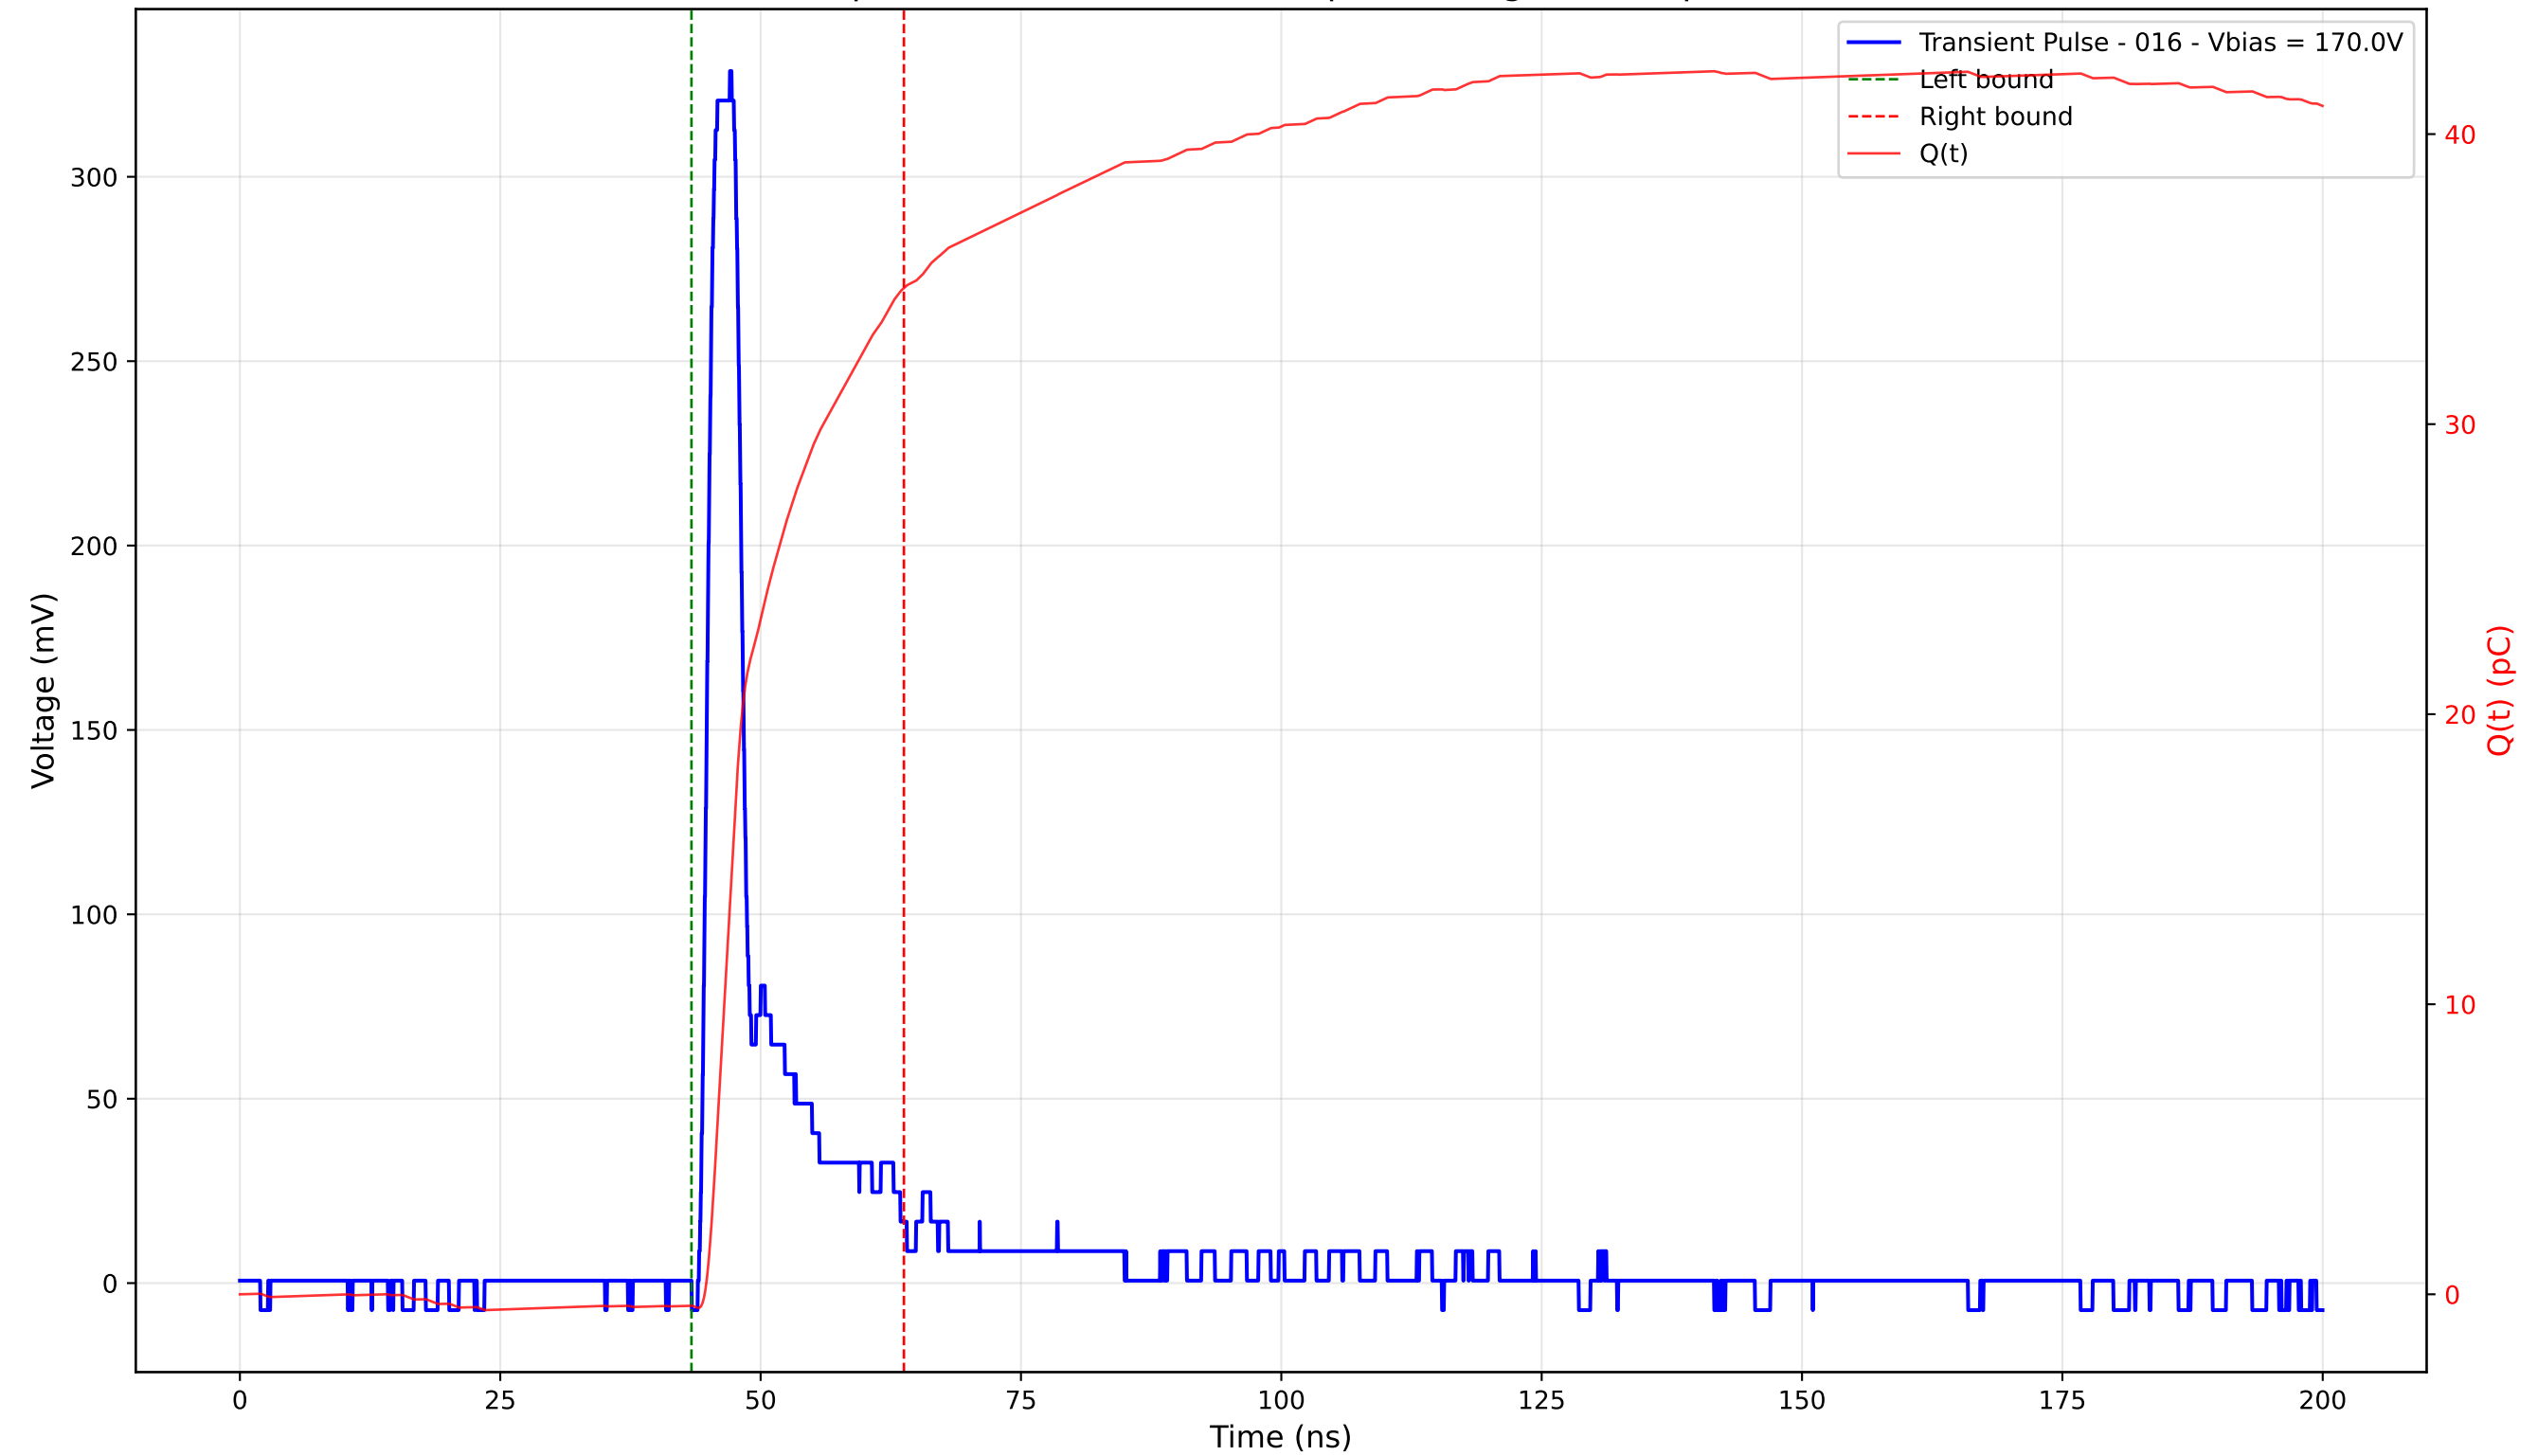


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 34.88 pC - Rise Time: 1.26 ns

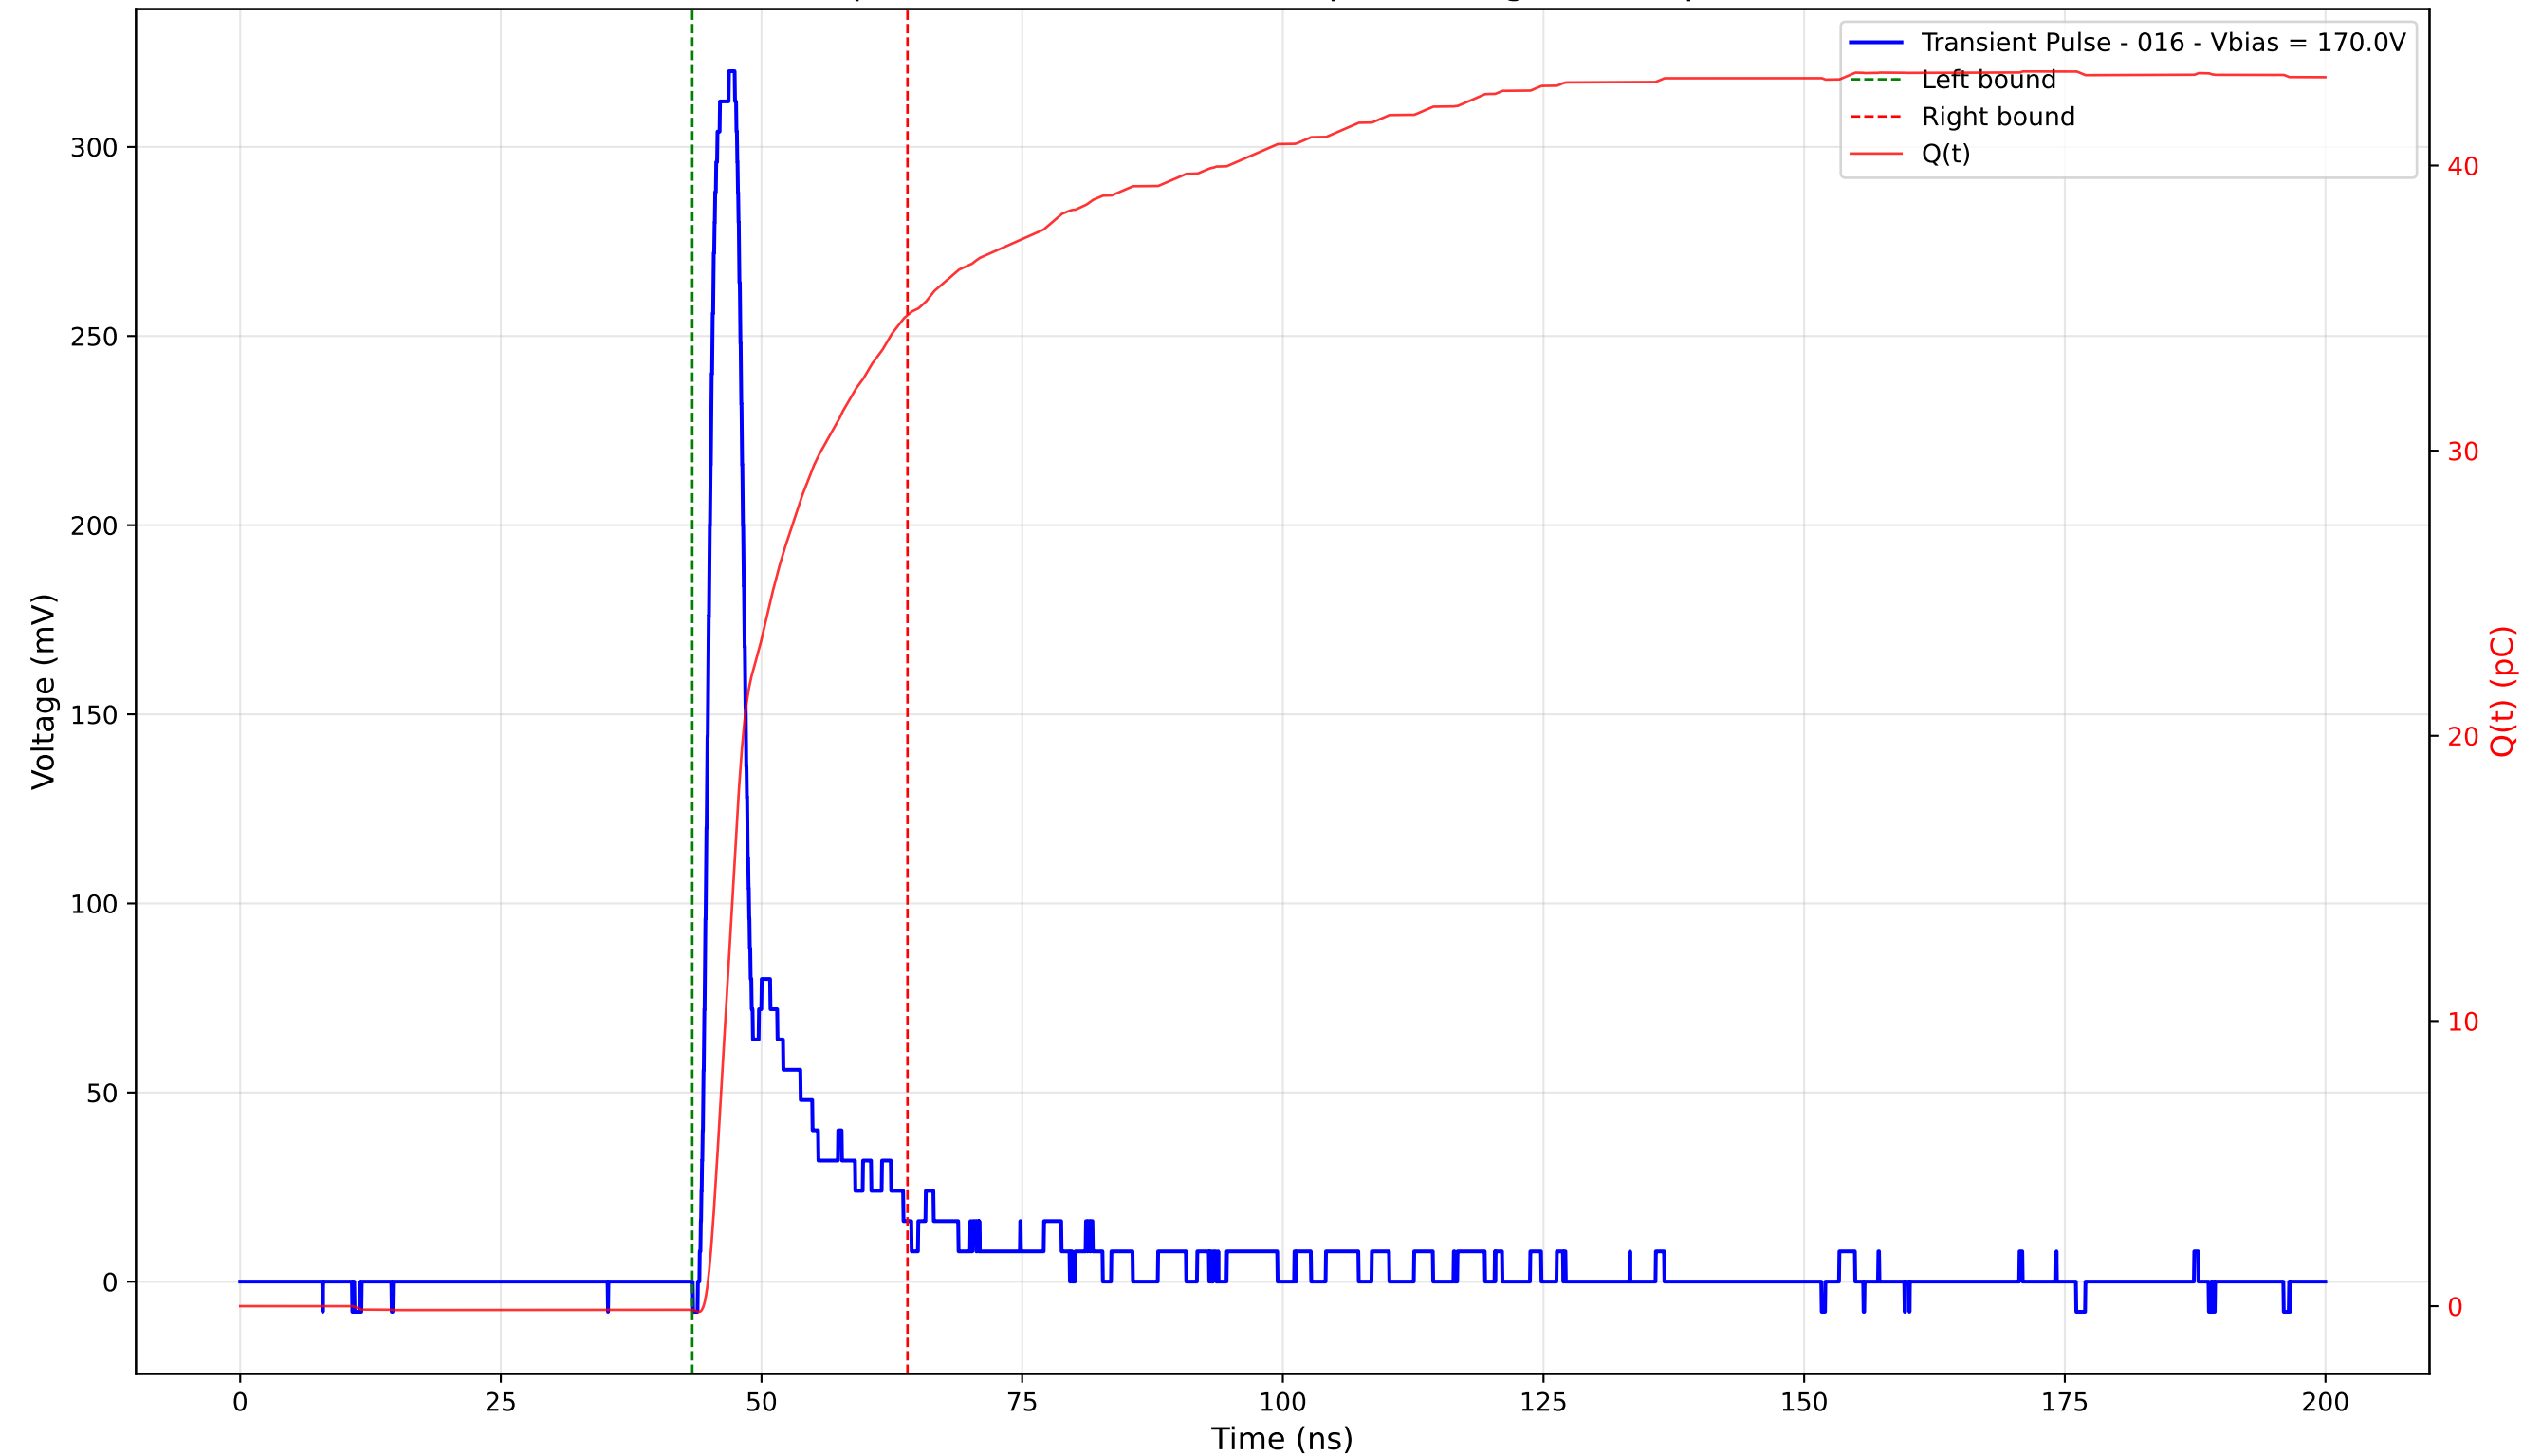


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 35.07 pC - Rise Time: 1.51 ns

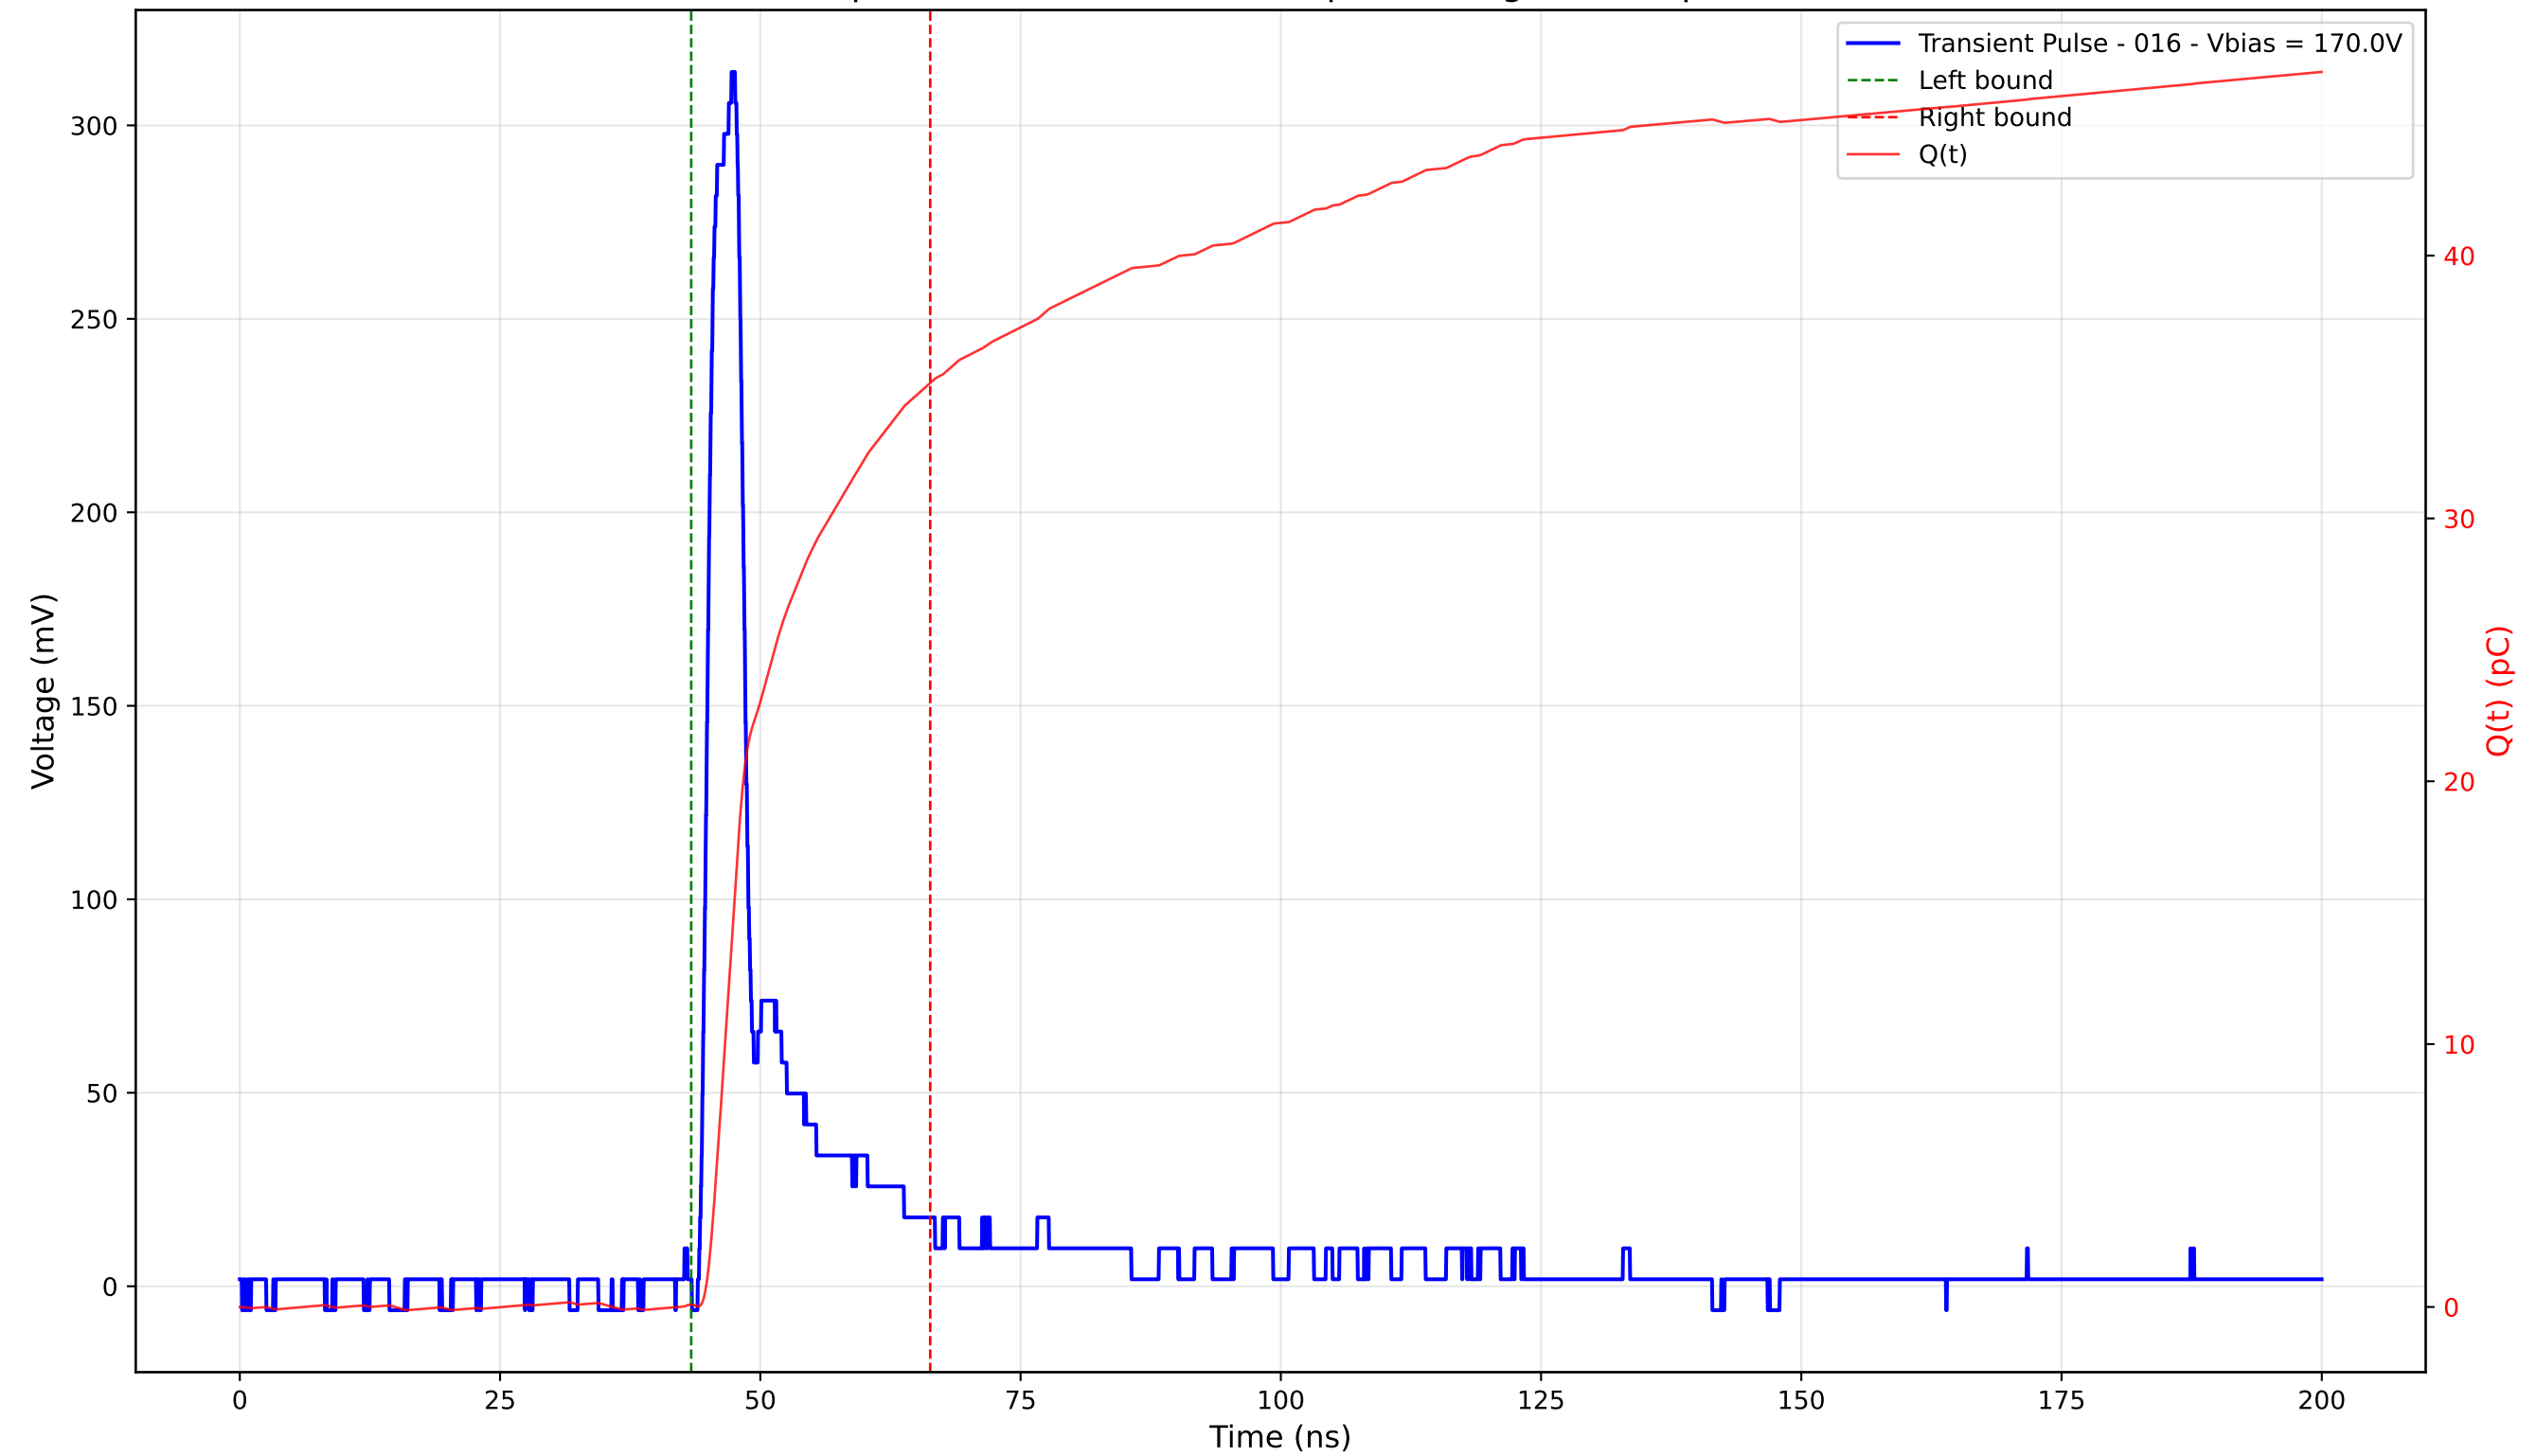


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 34.60 pC - Rise Time: 2.41 ns

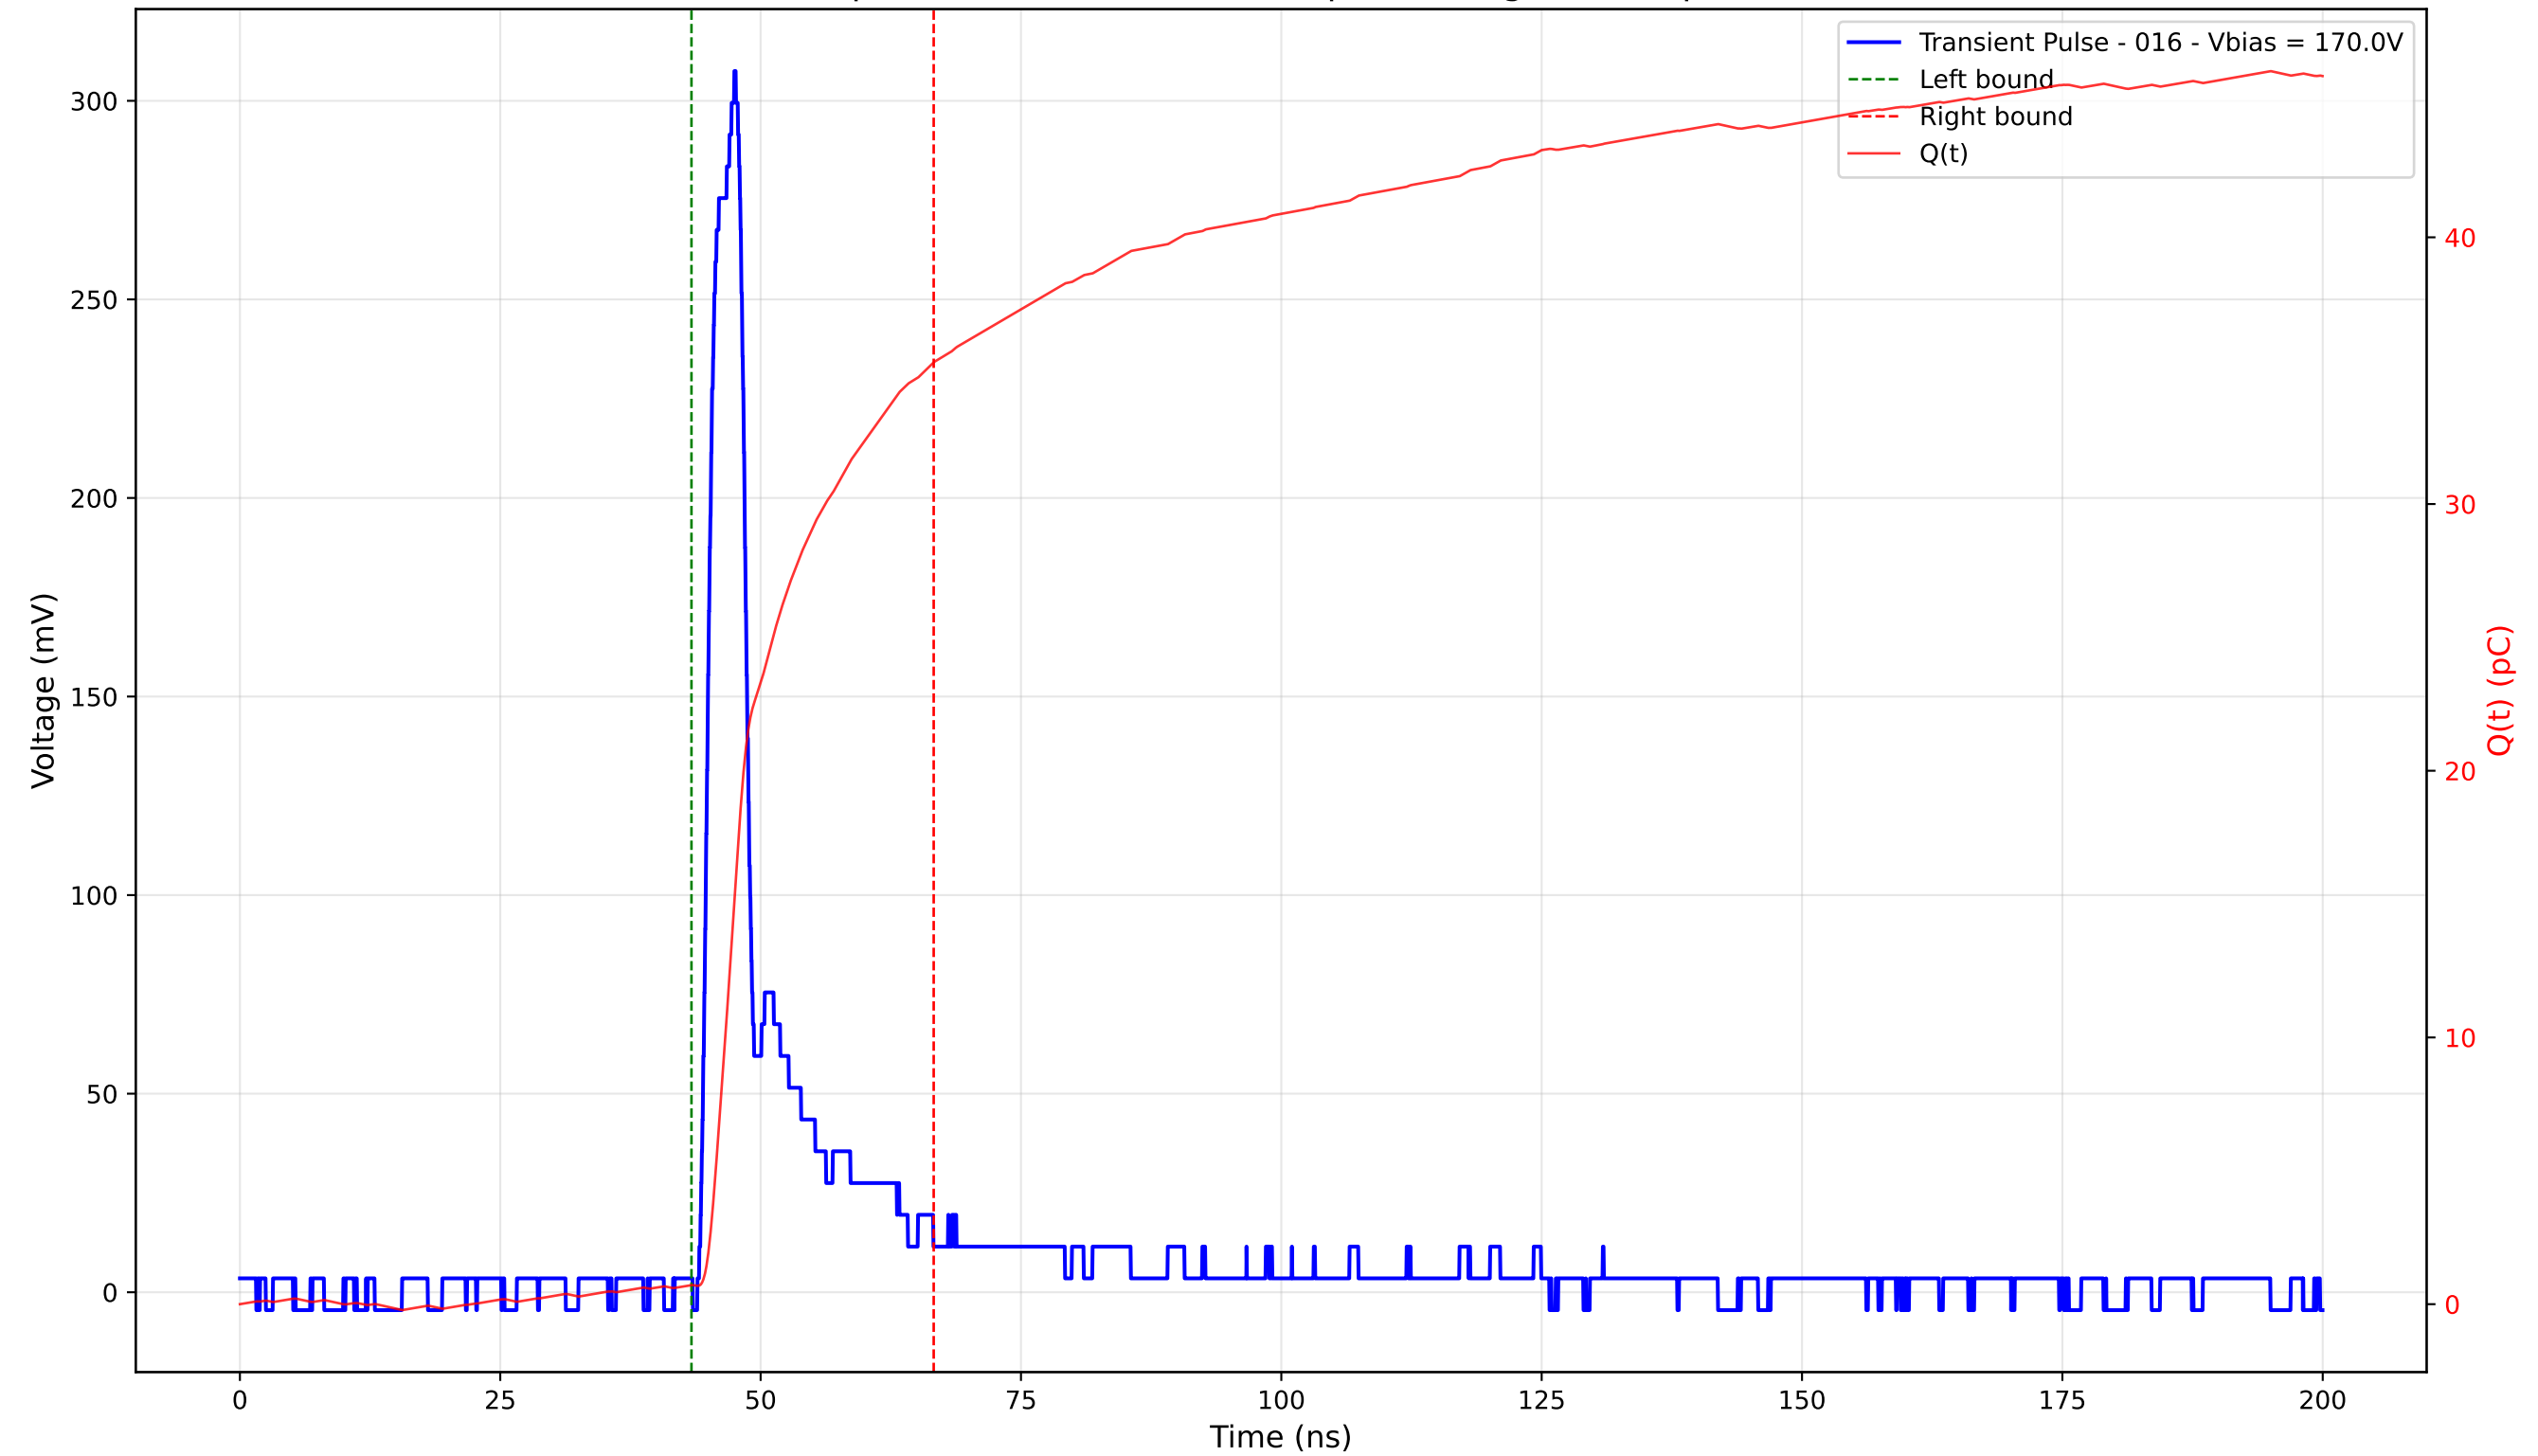


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 33.41 pC - Rise Time: 2.61 ns

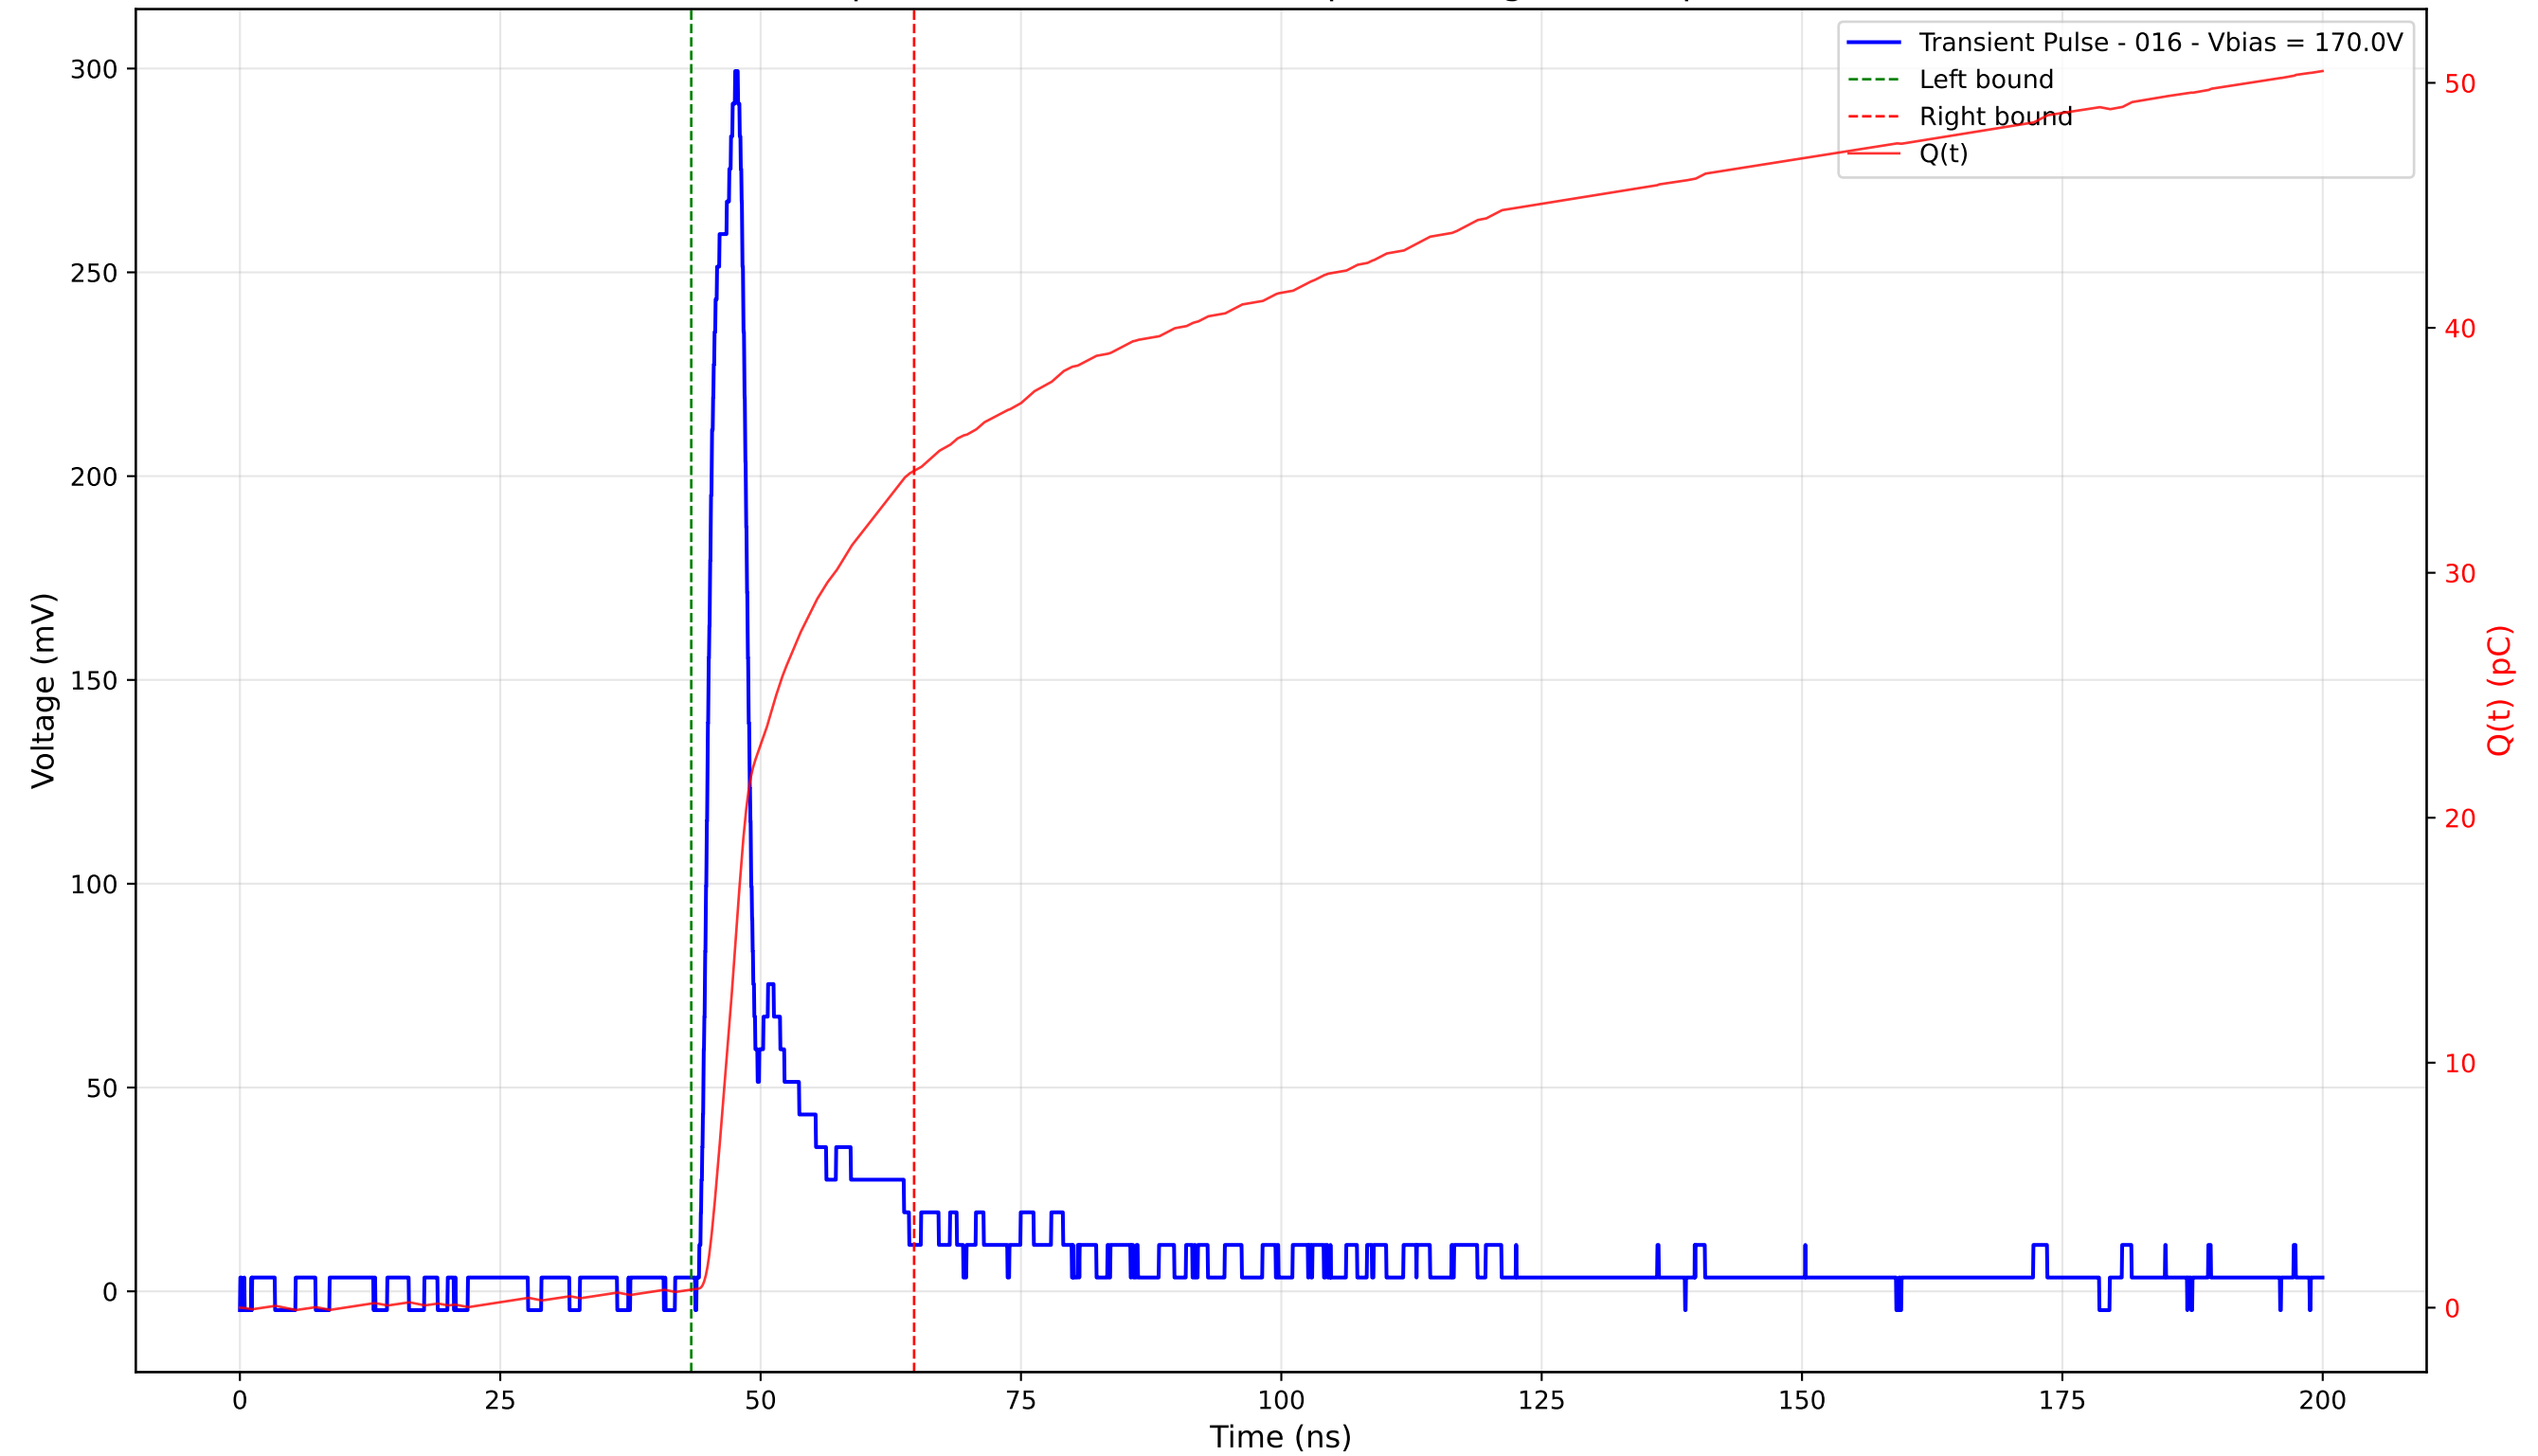


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 31.46 pC - Rise Time: 2.74 ns

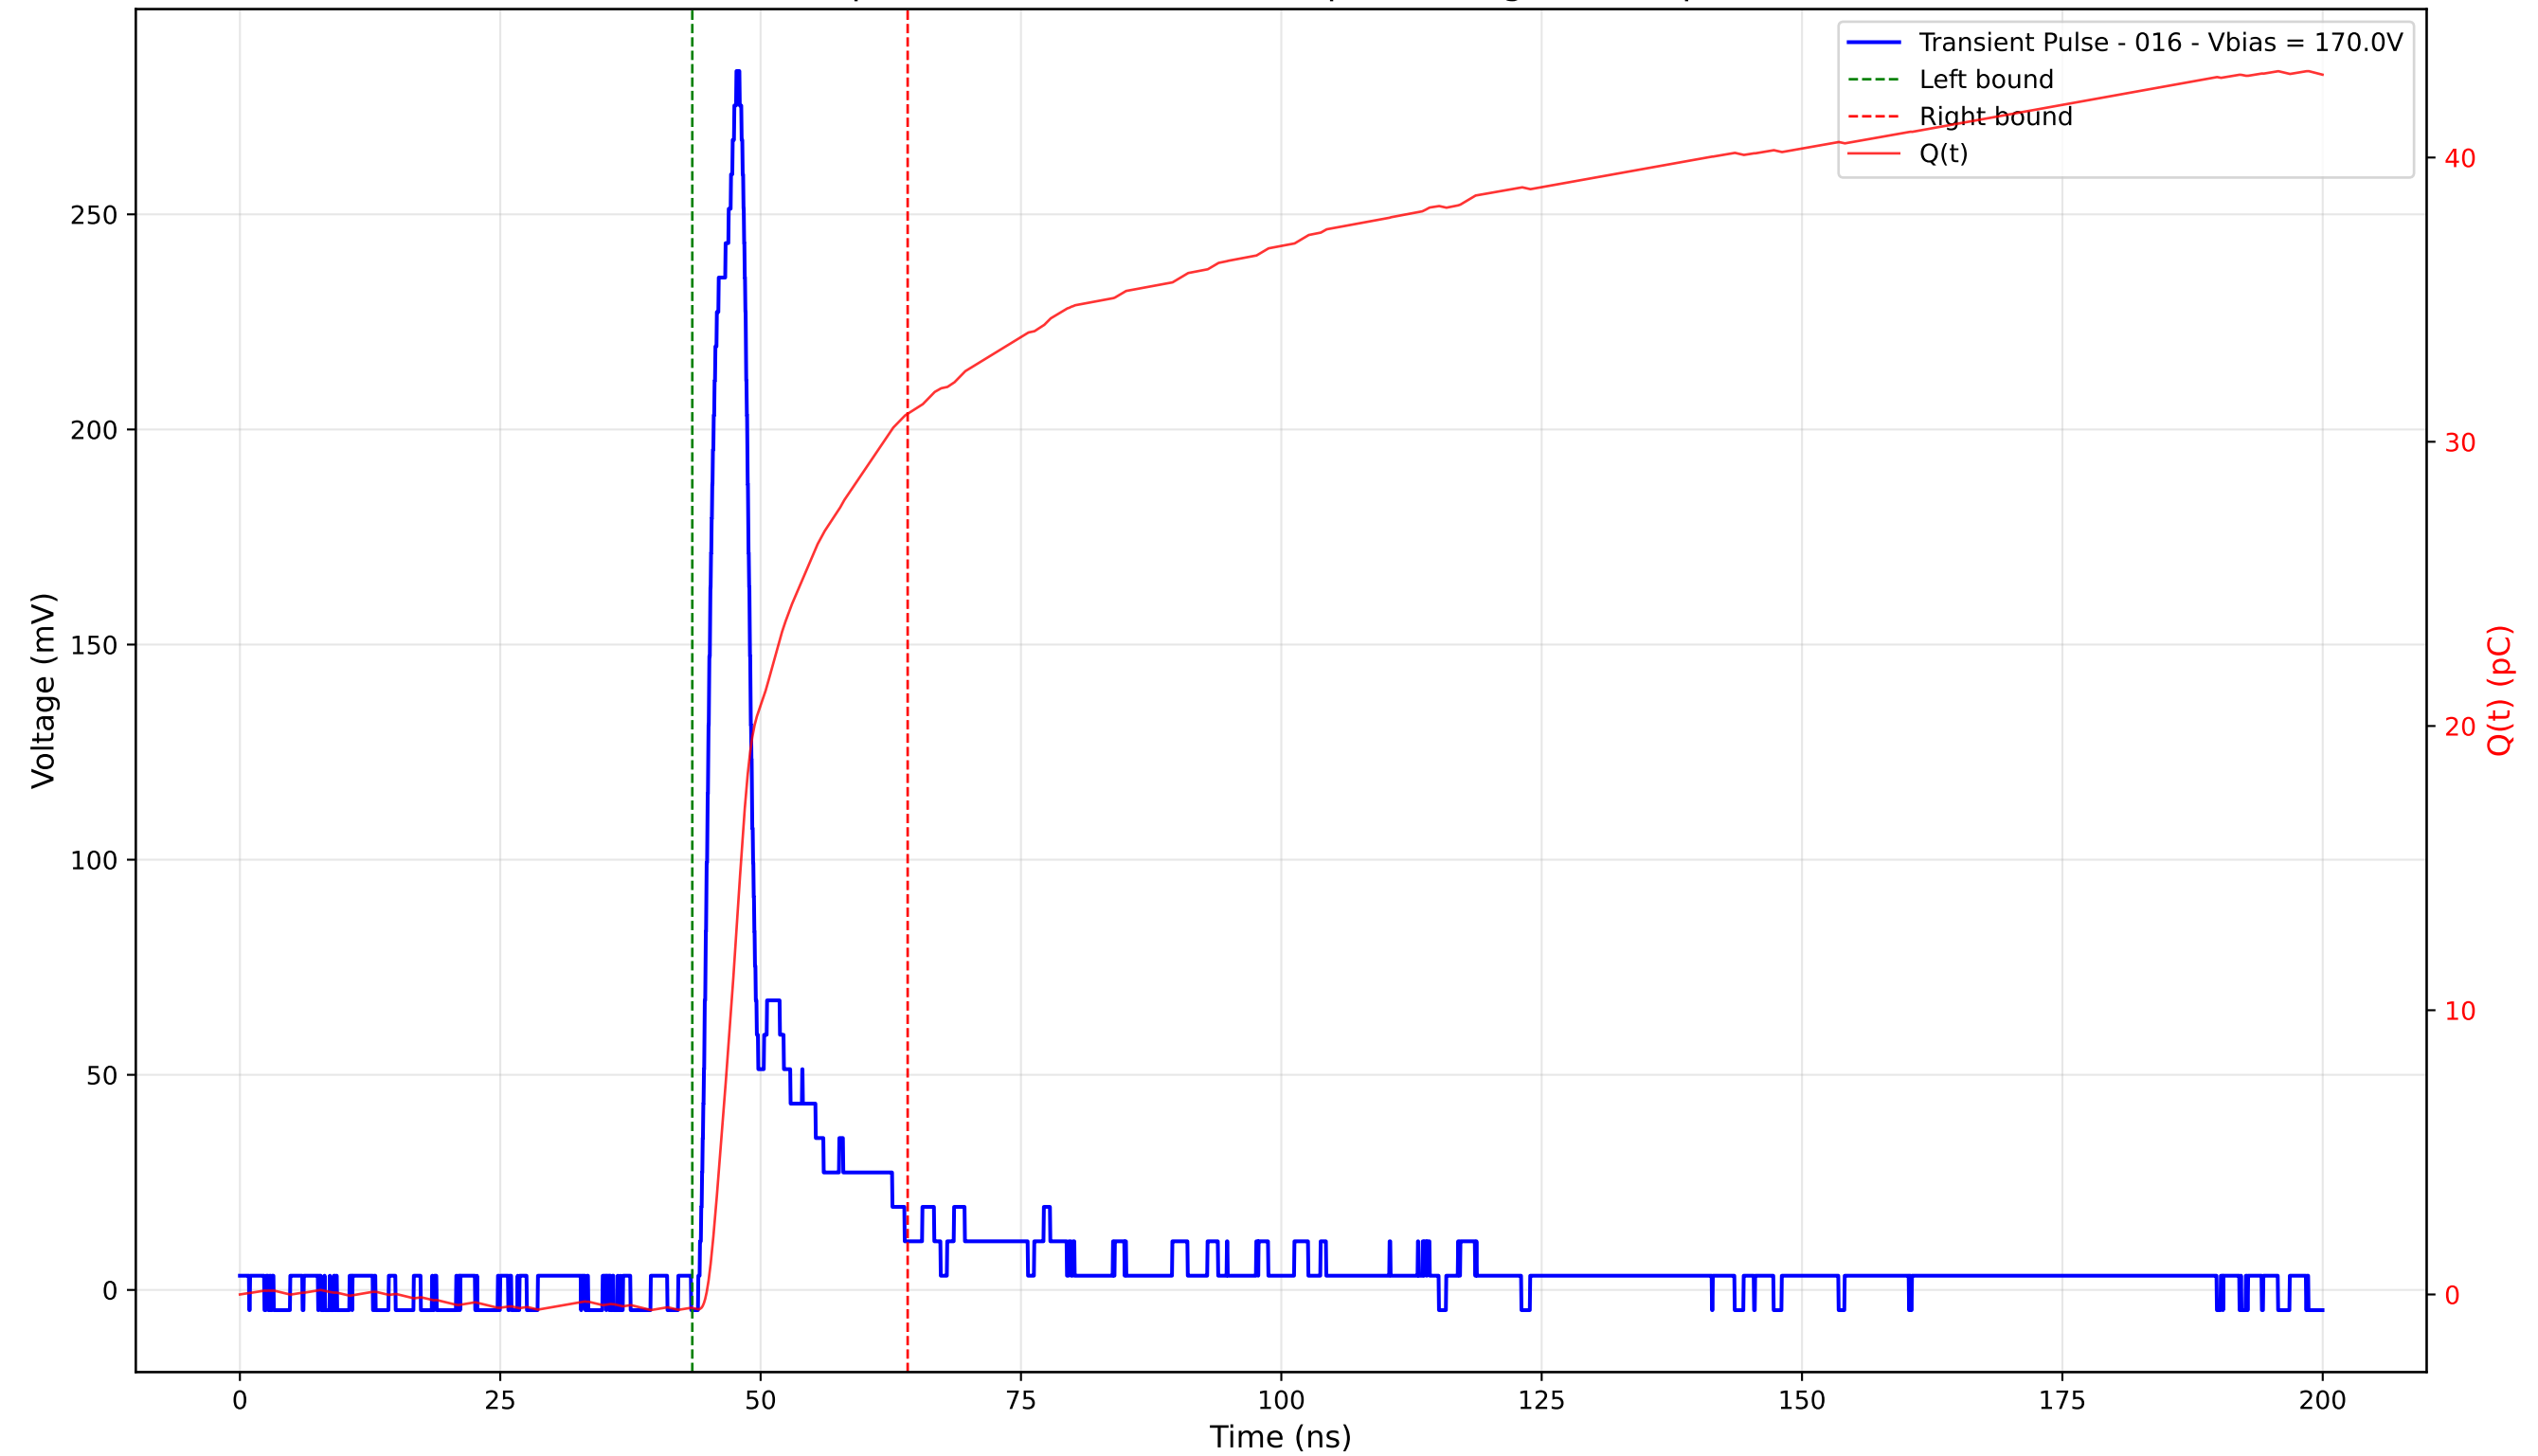


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 33.34 pC - Rise Time: 2.92 ns

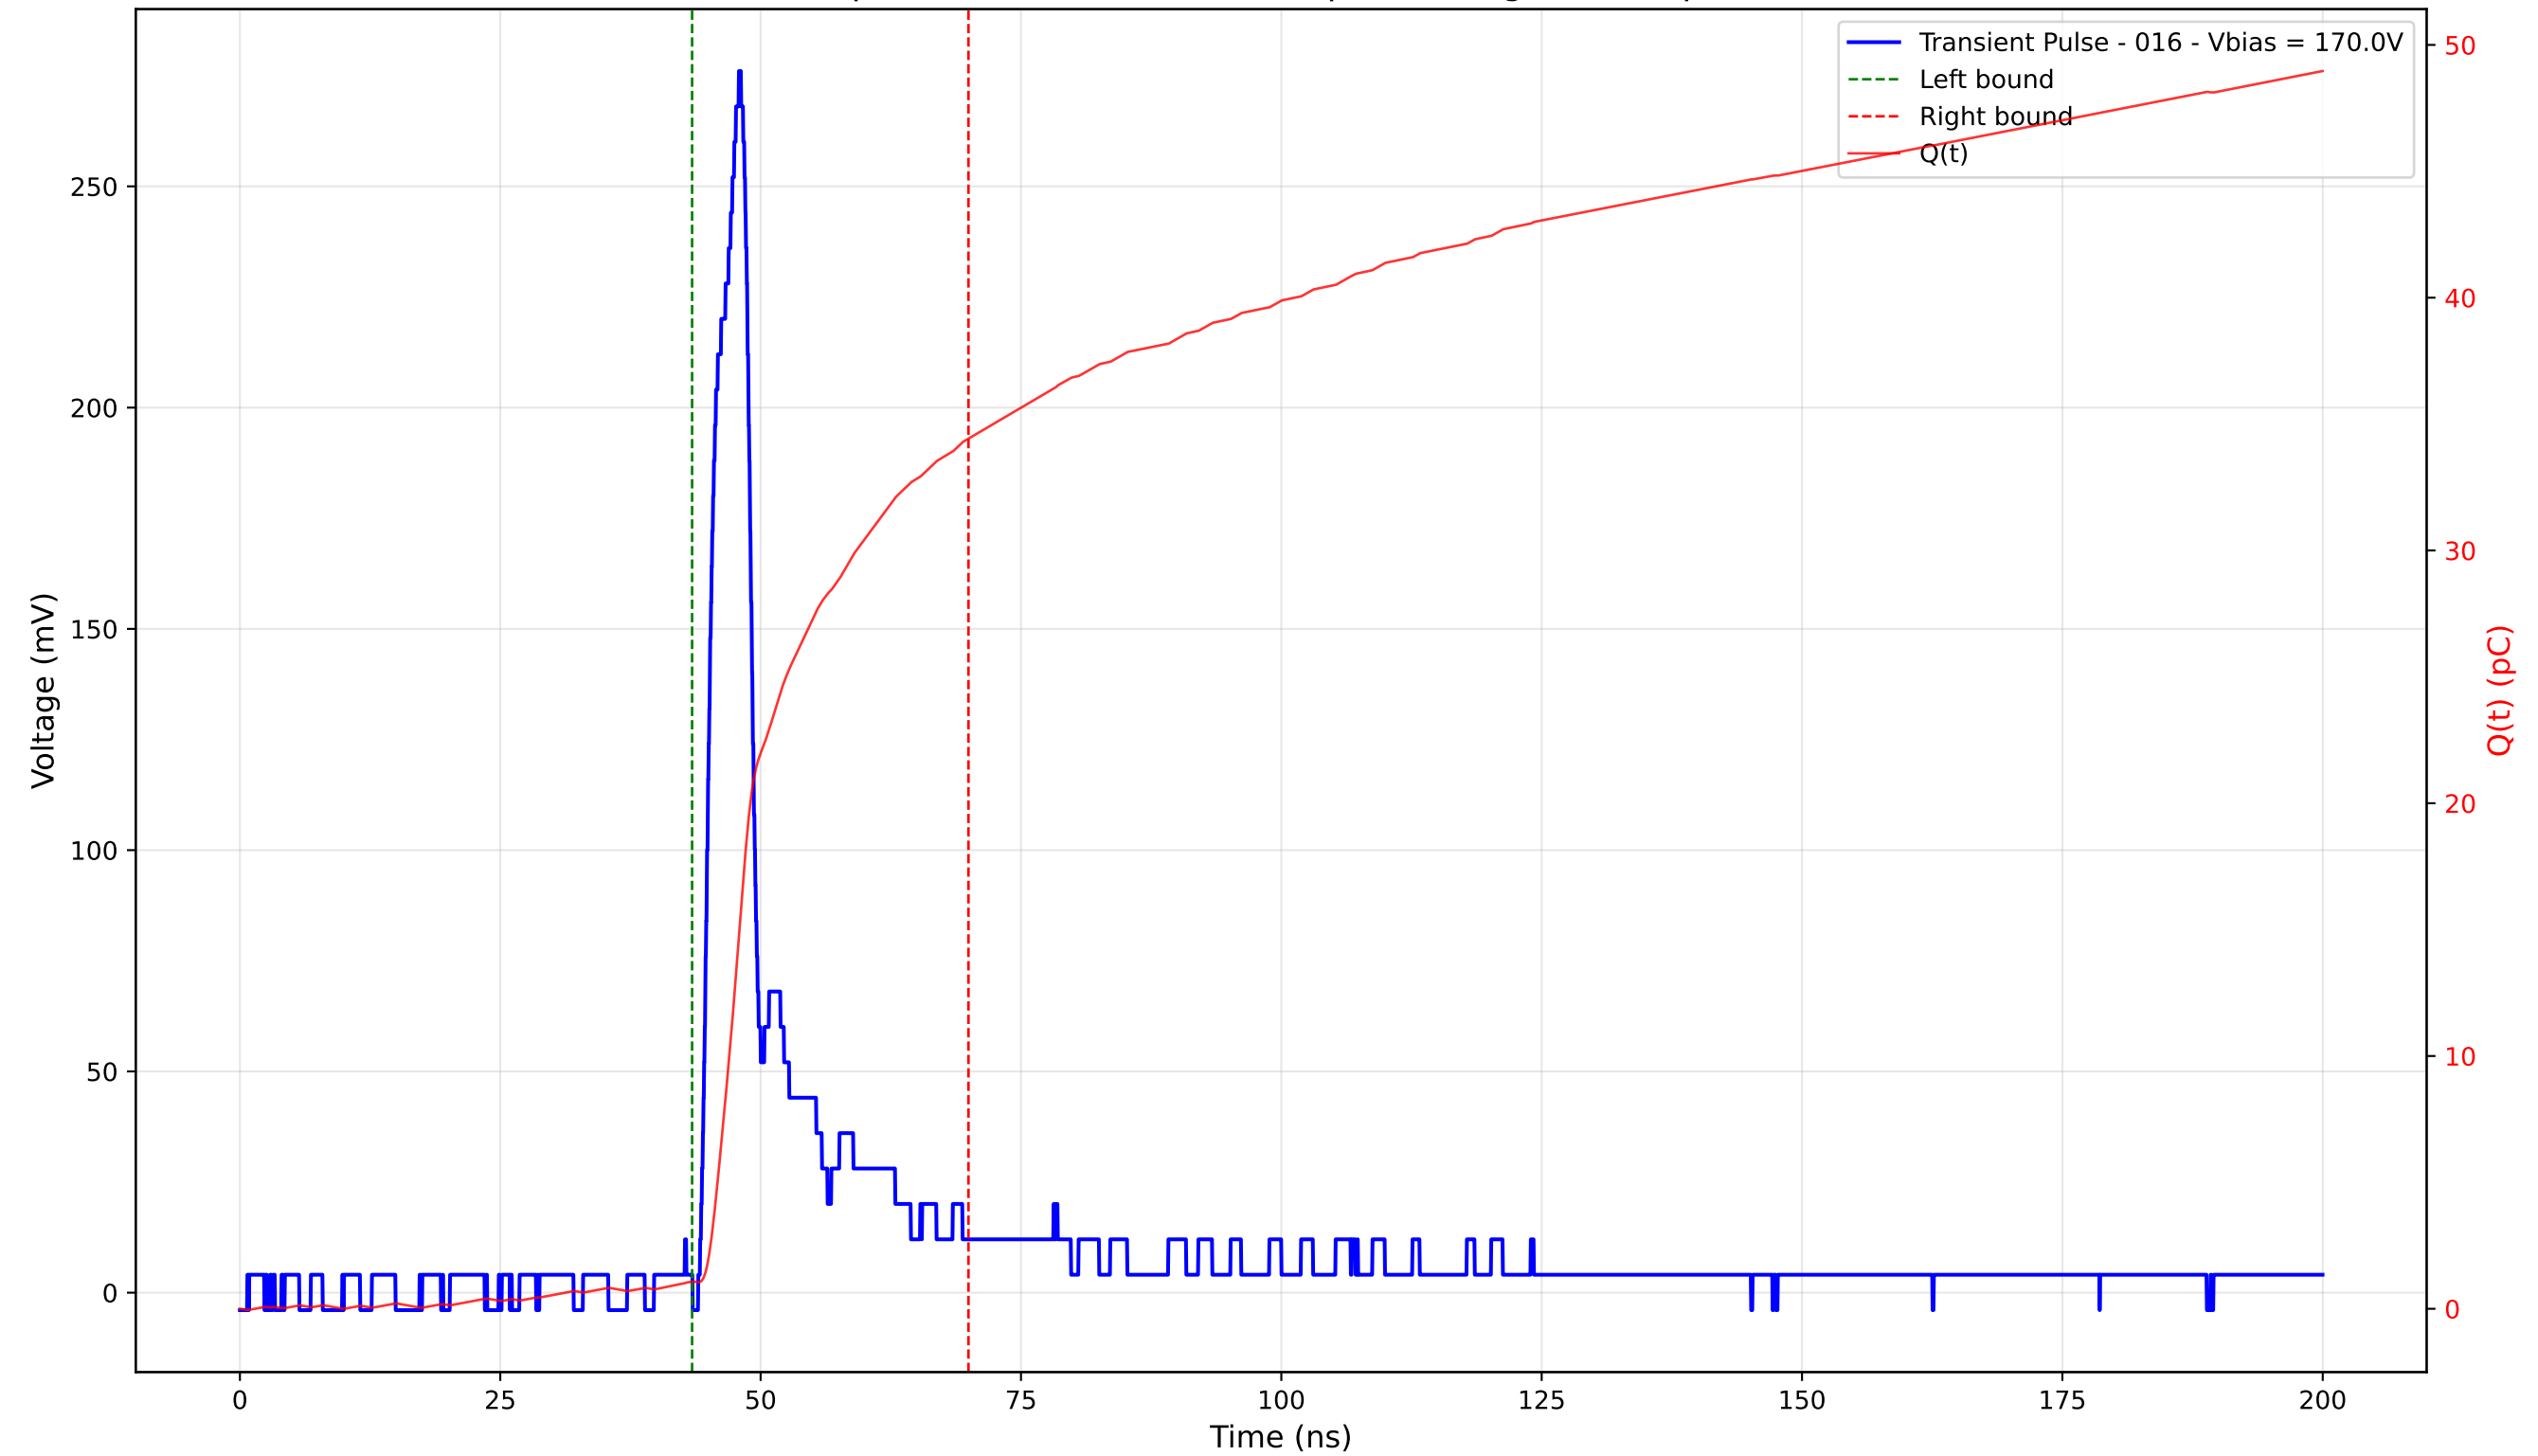


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 31.65 pC - Rise Time: 3.14 ns

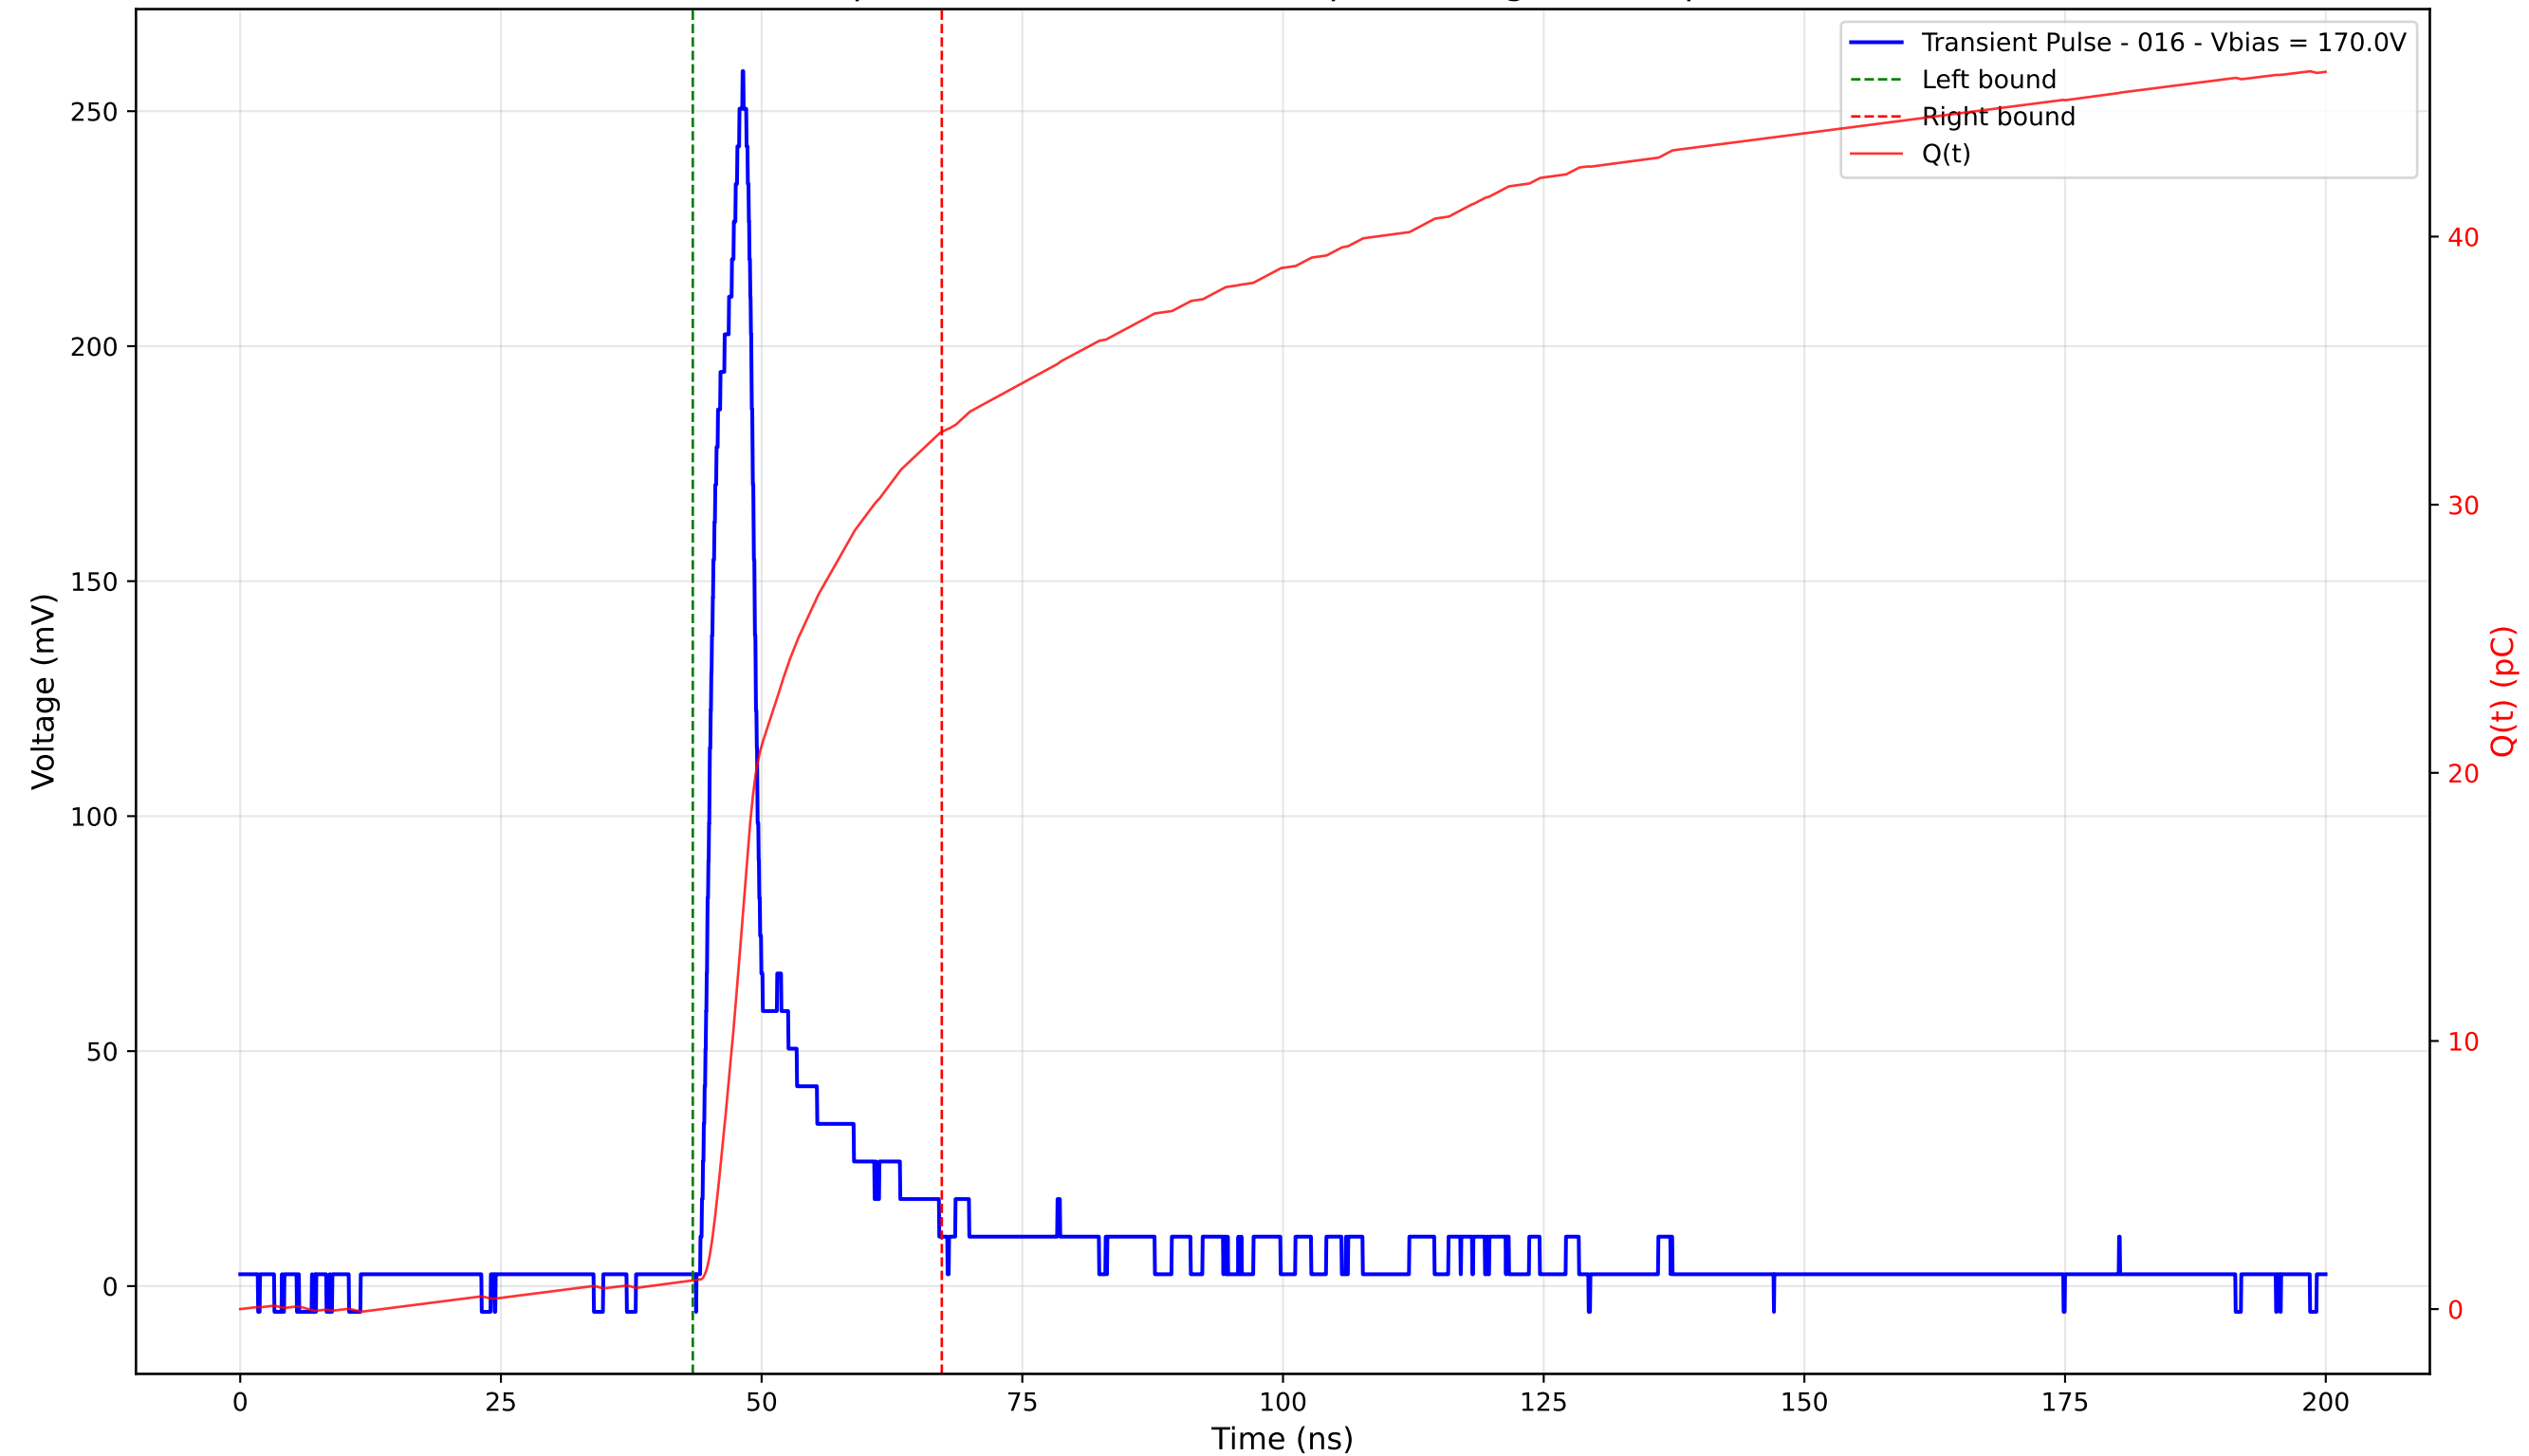


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 28.94 pC - Rise Time: 3.24 ns

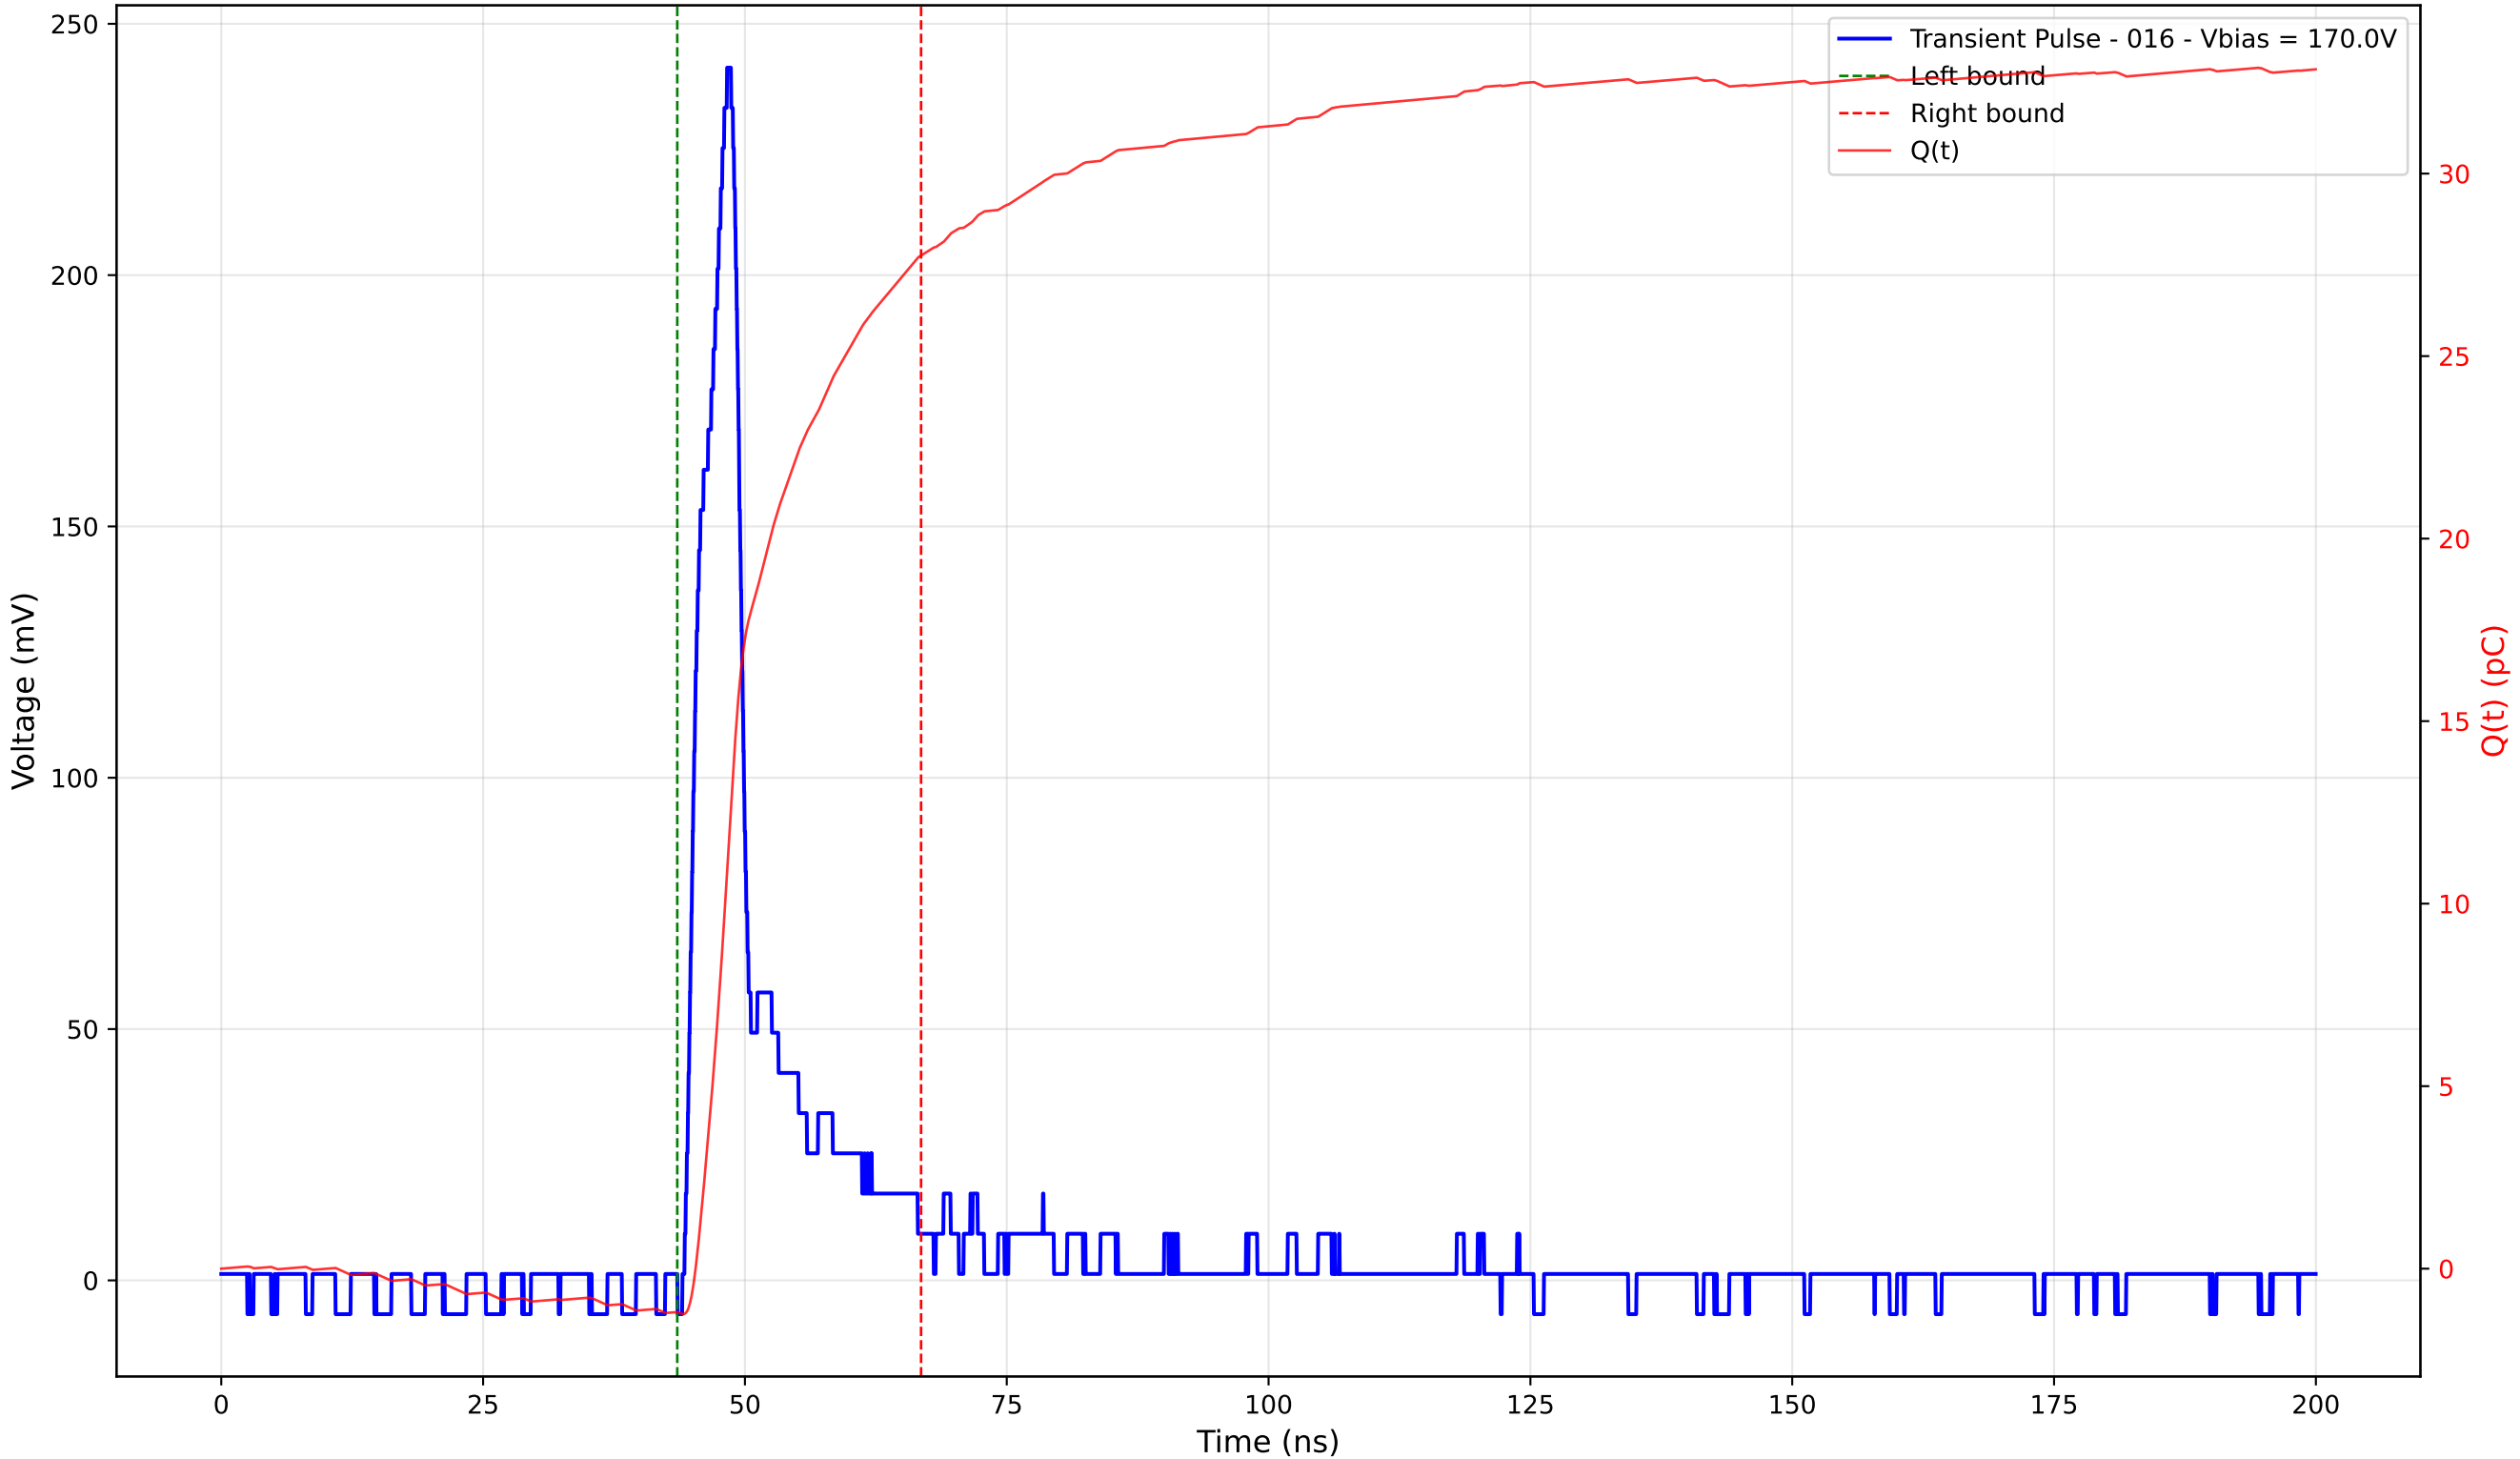


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 29.48 pC - Rise Time: 3.57 ns

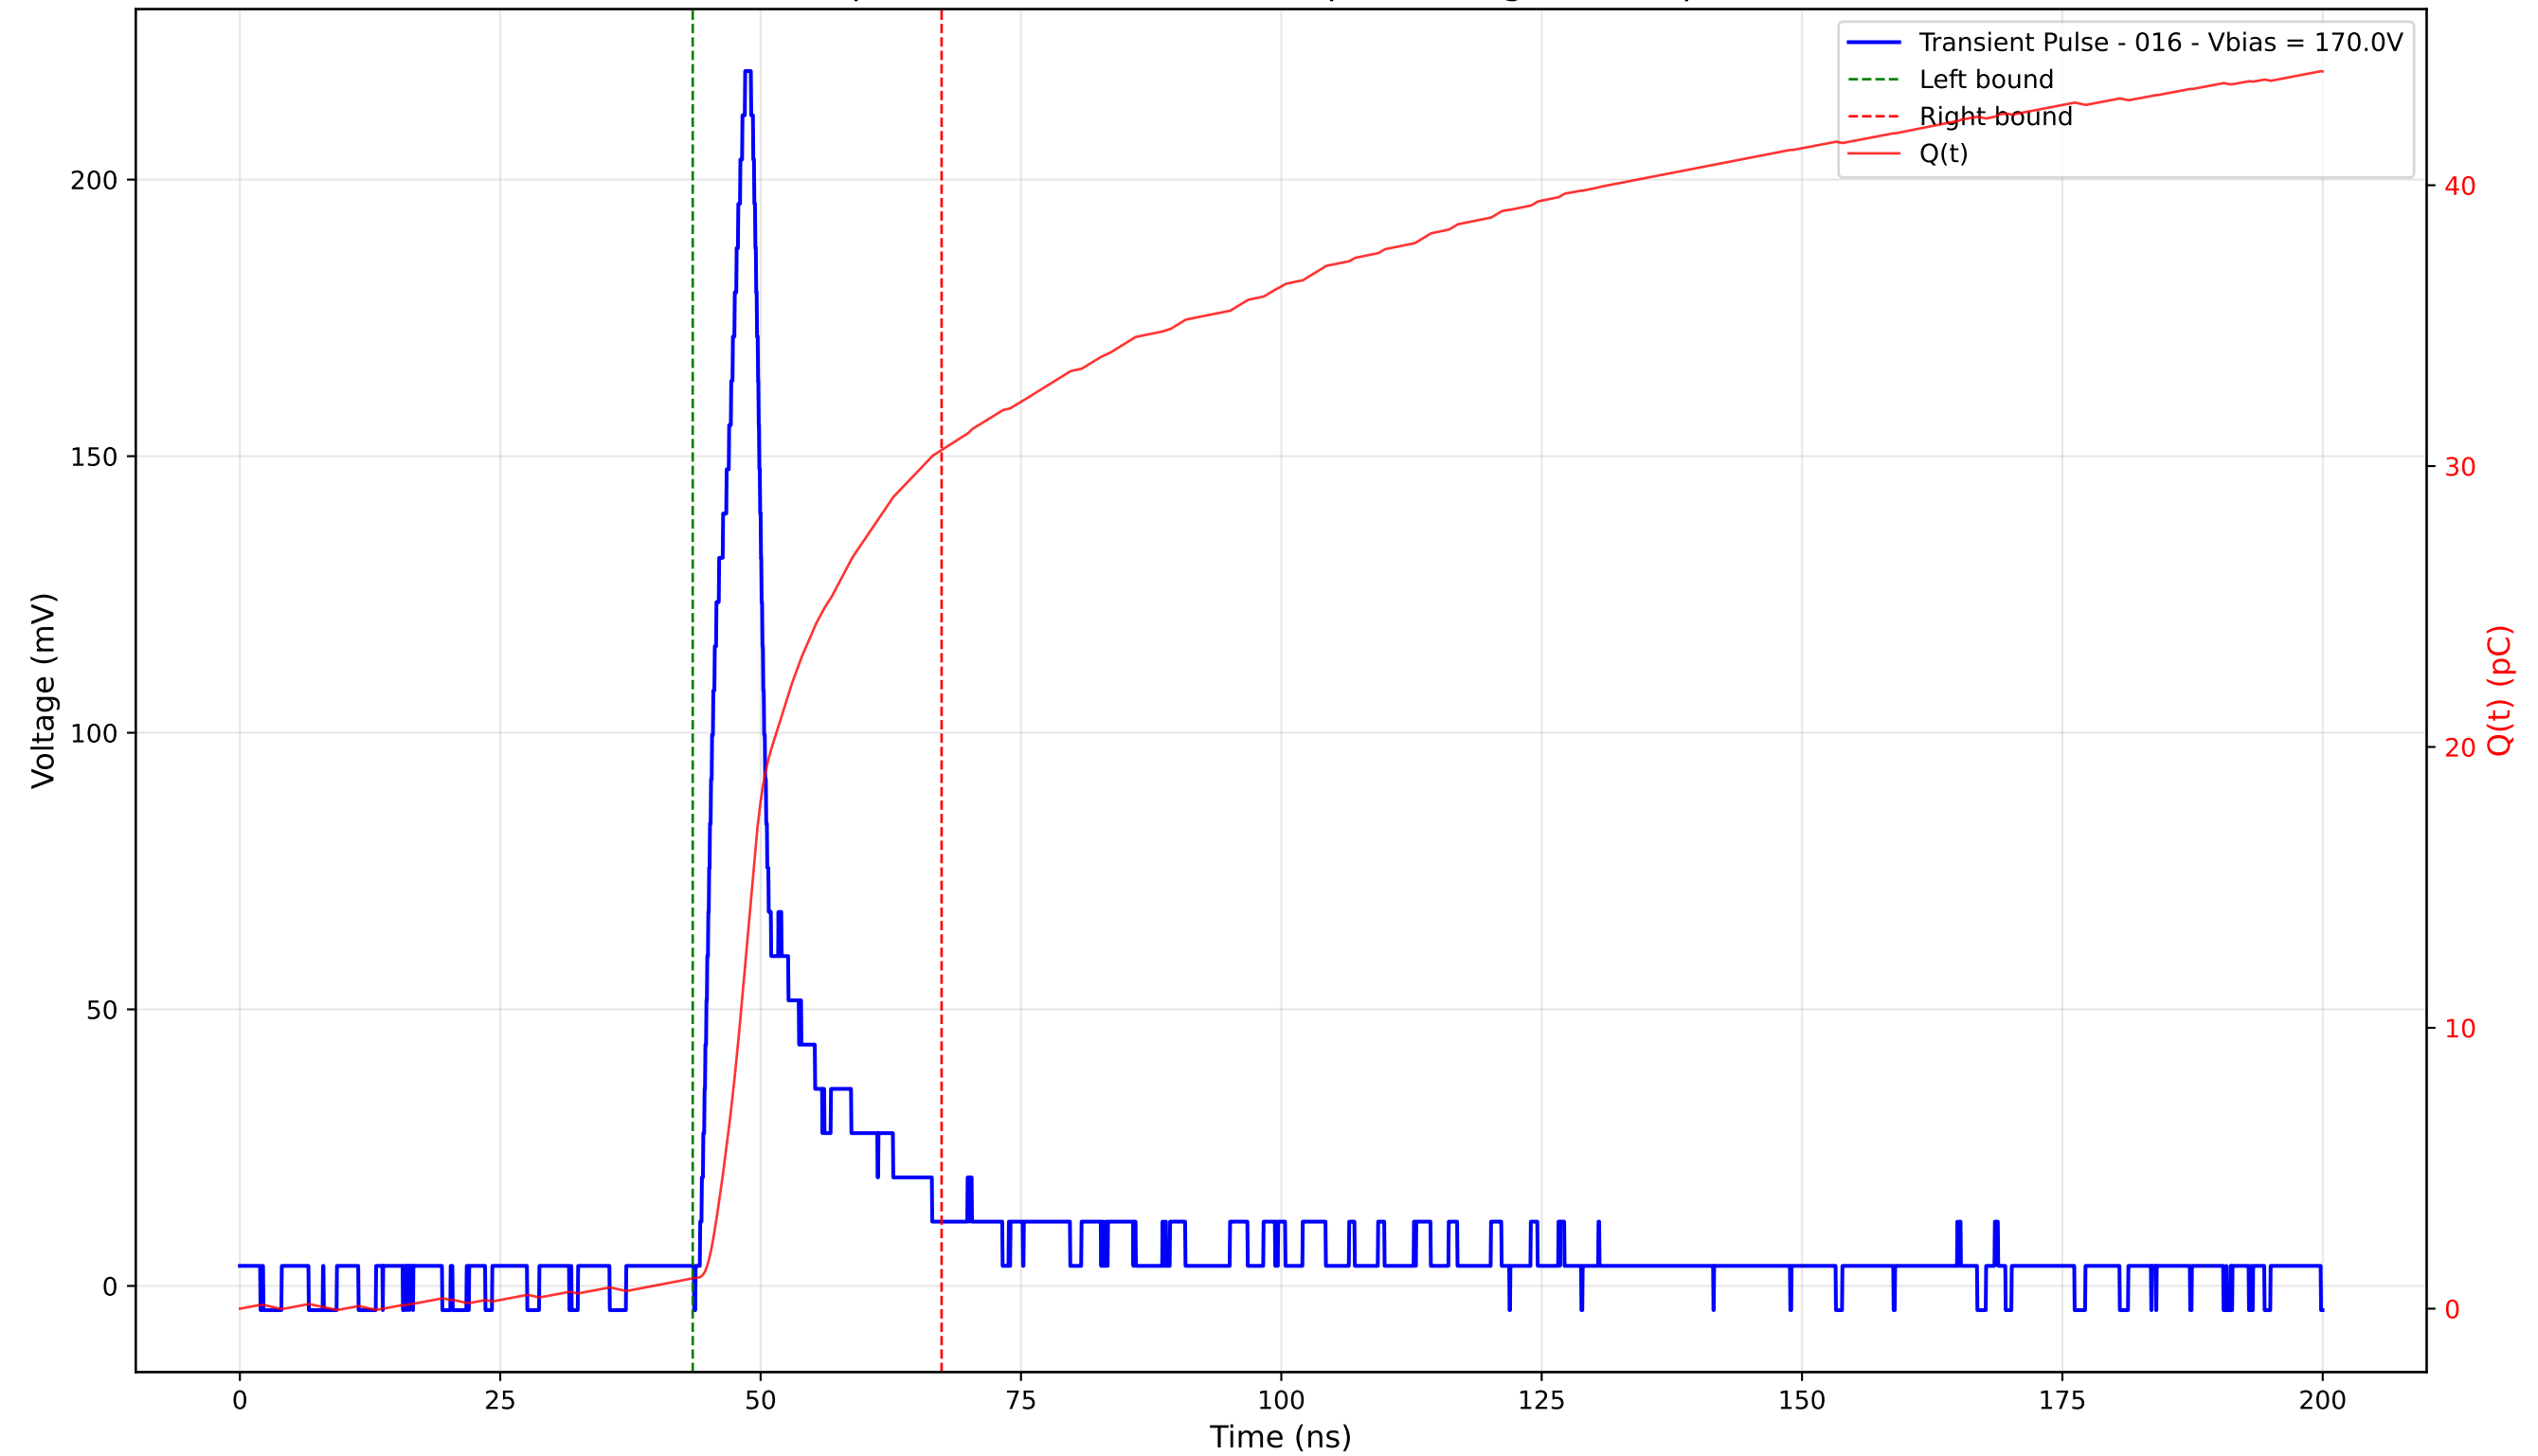


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 32.32 pC - Rise Time: 3.41 ns

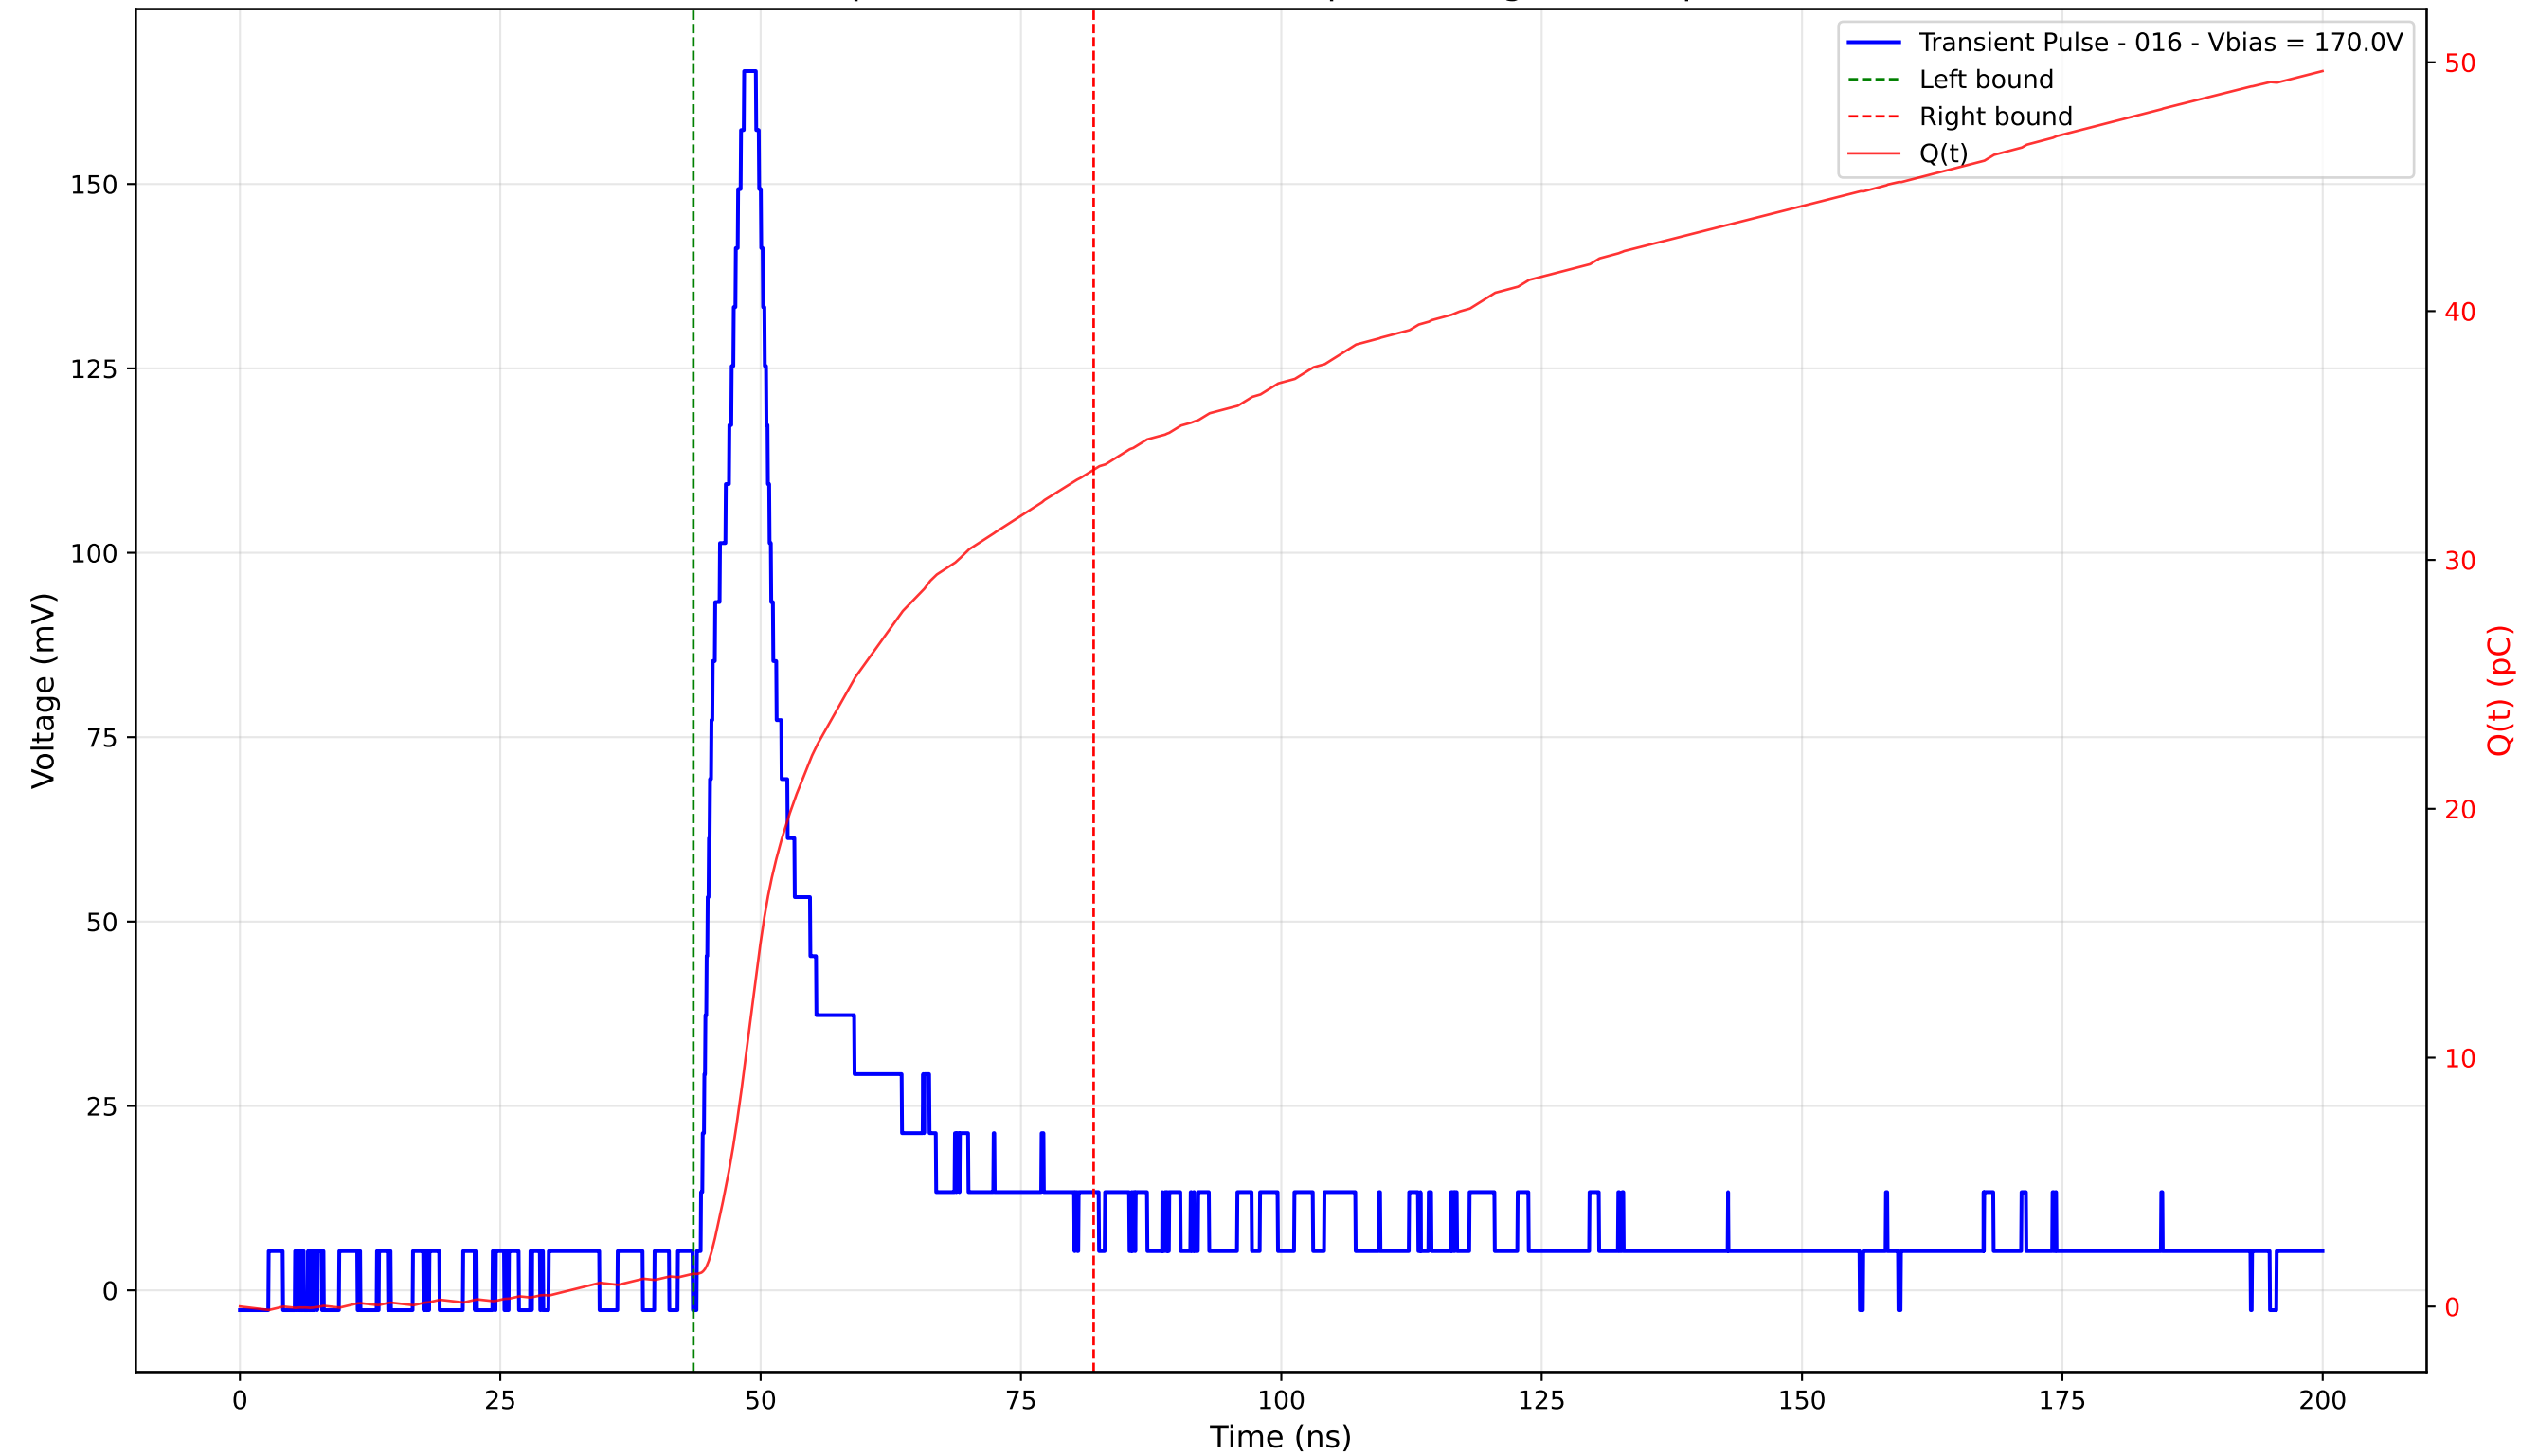


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 27.85 pC - Rise Time: 3.76 ns

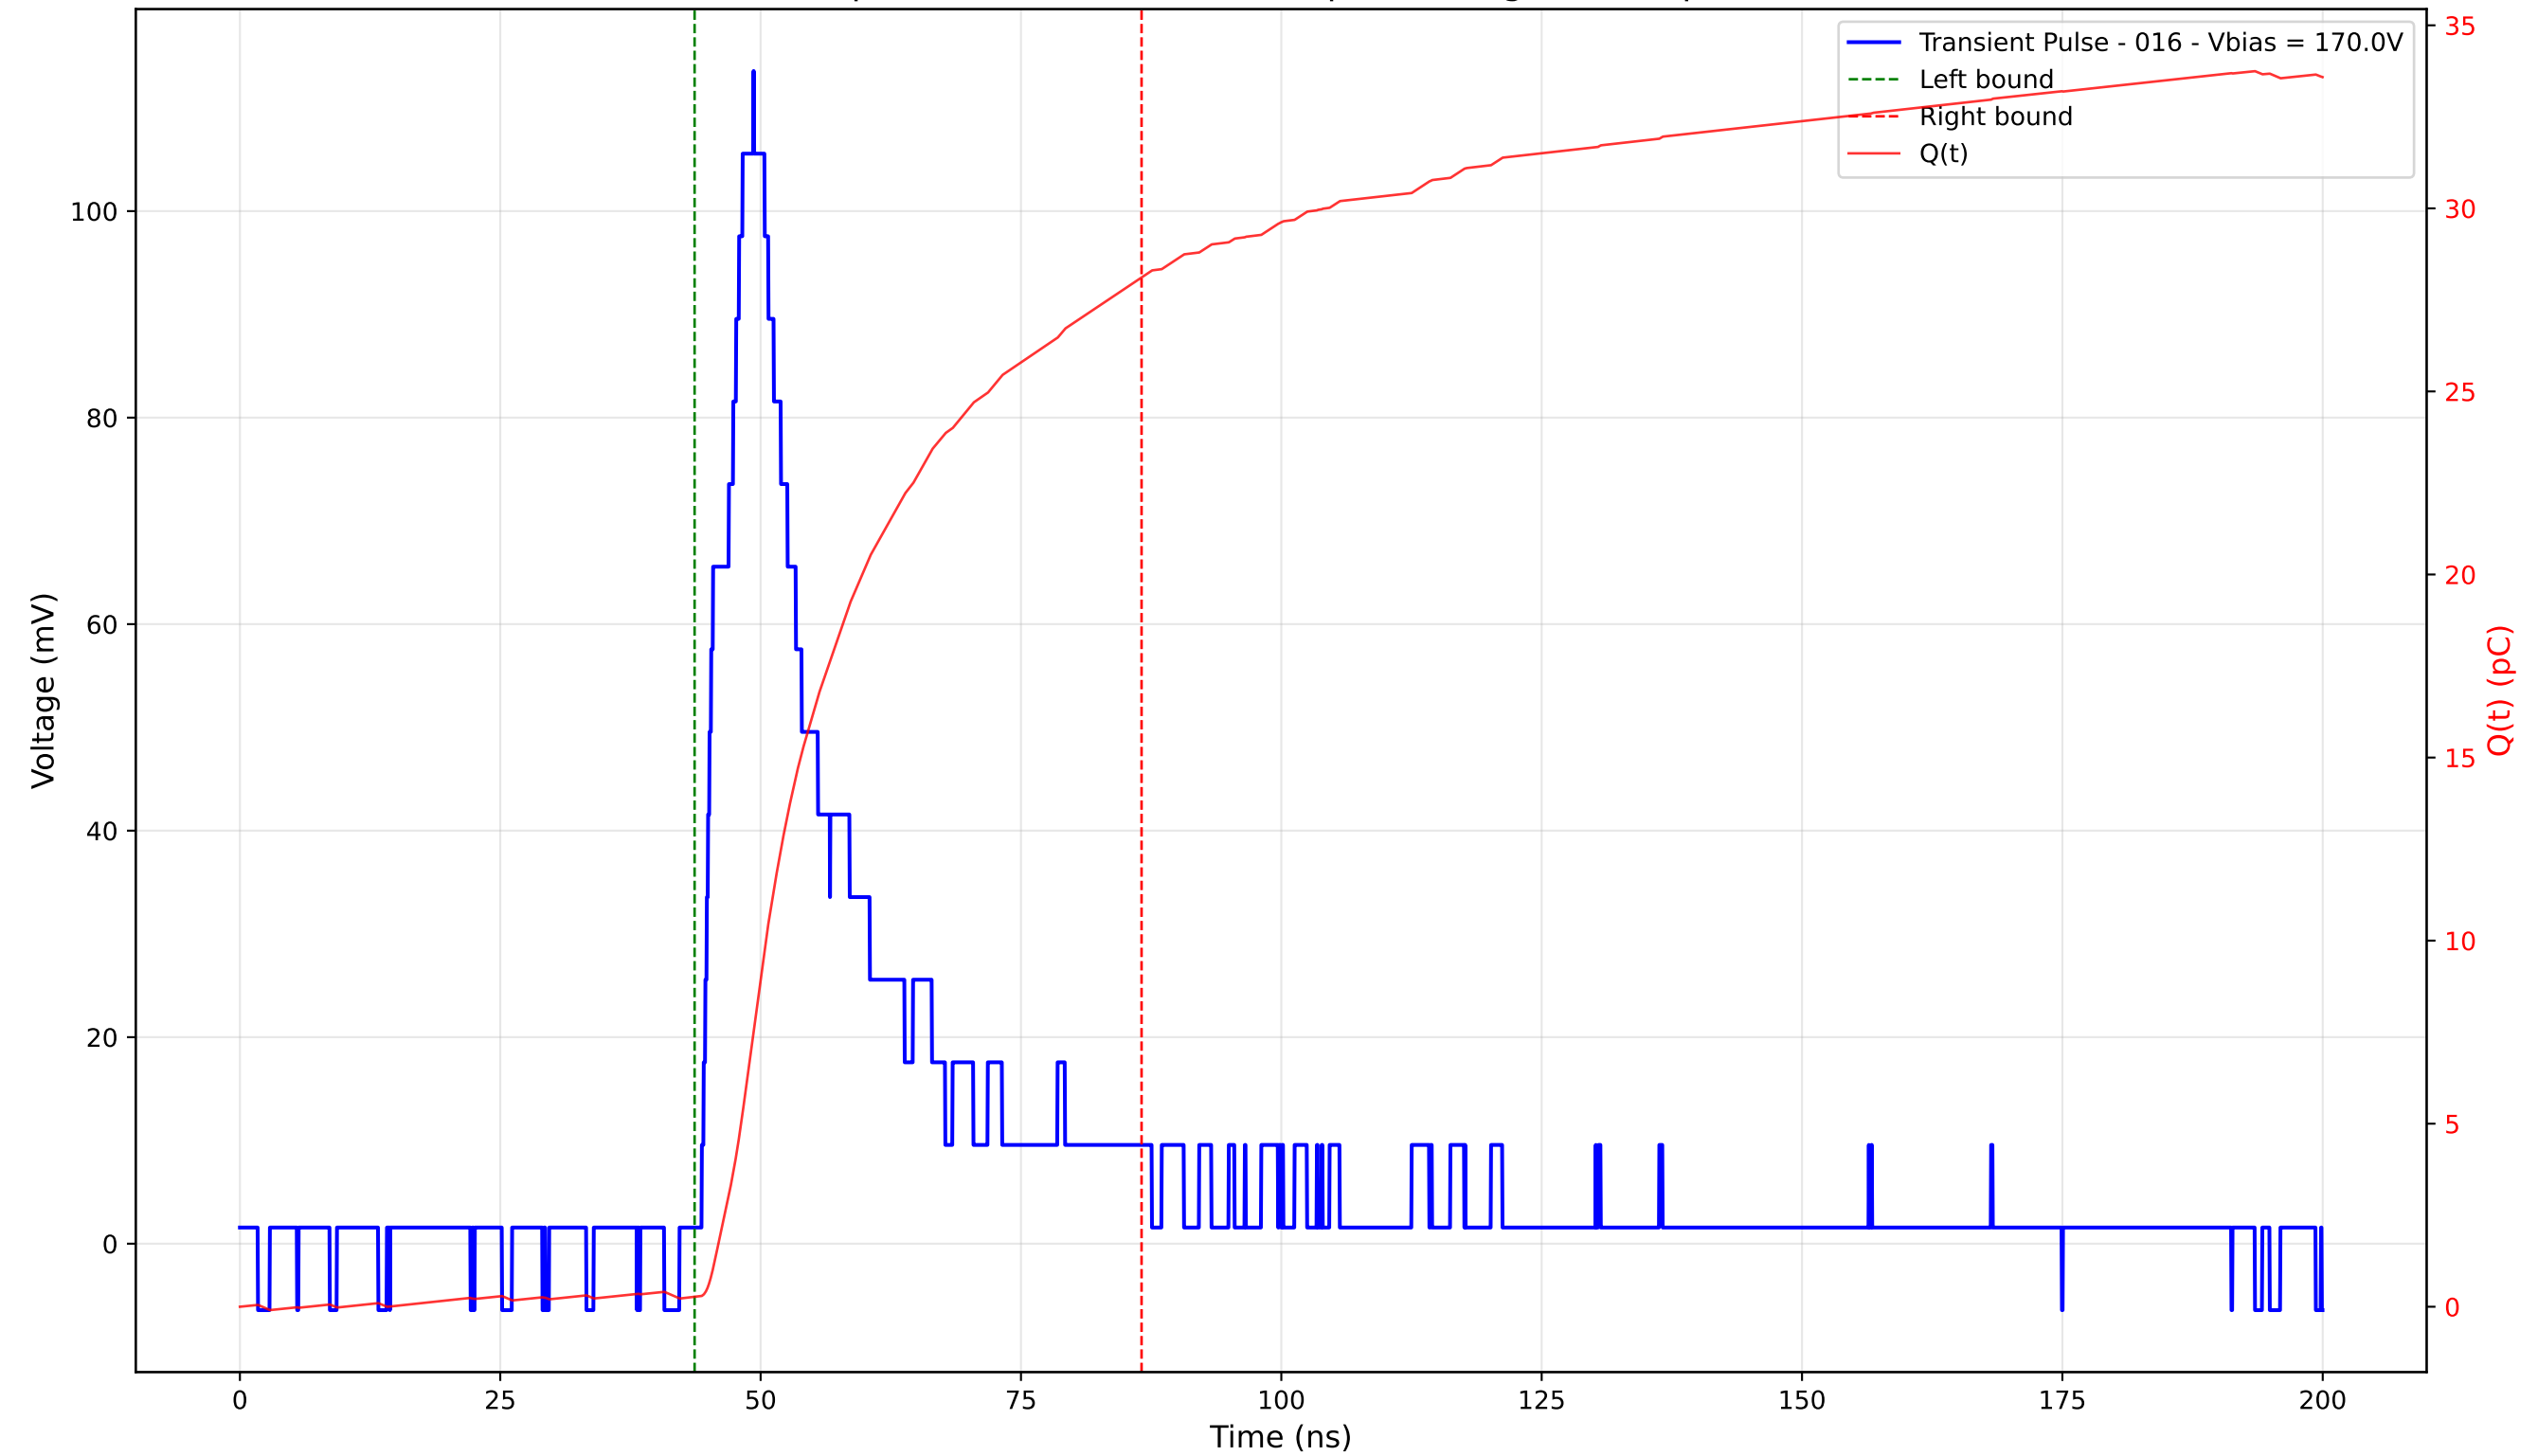


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 25.62 pC - Rise Time: 6.93 ns

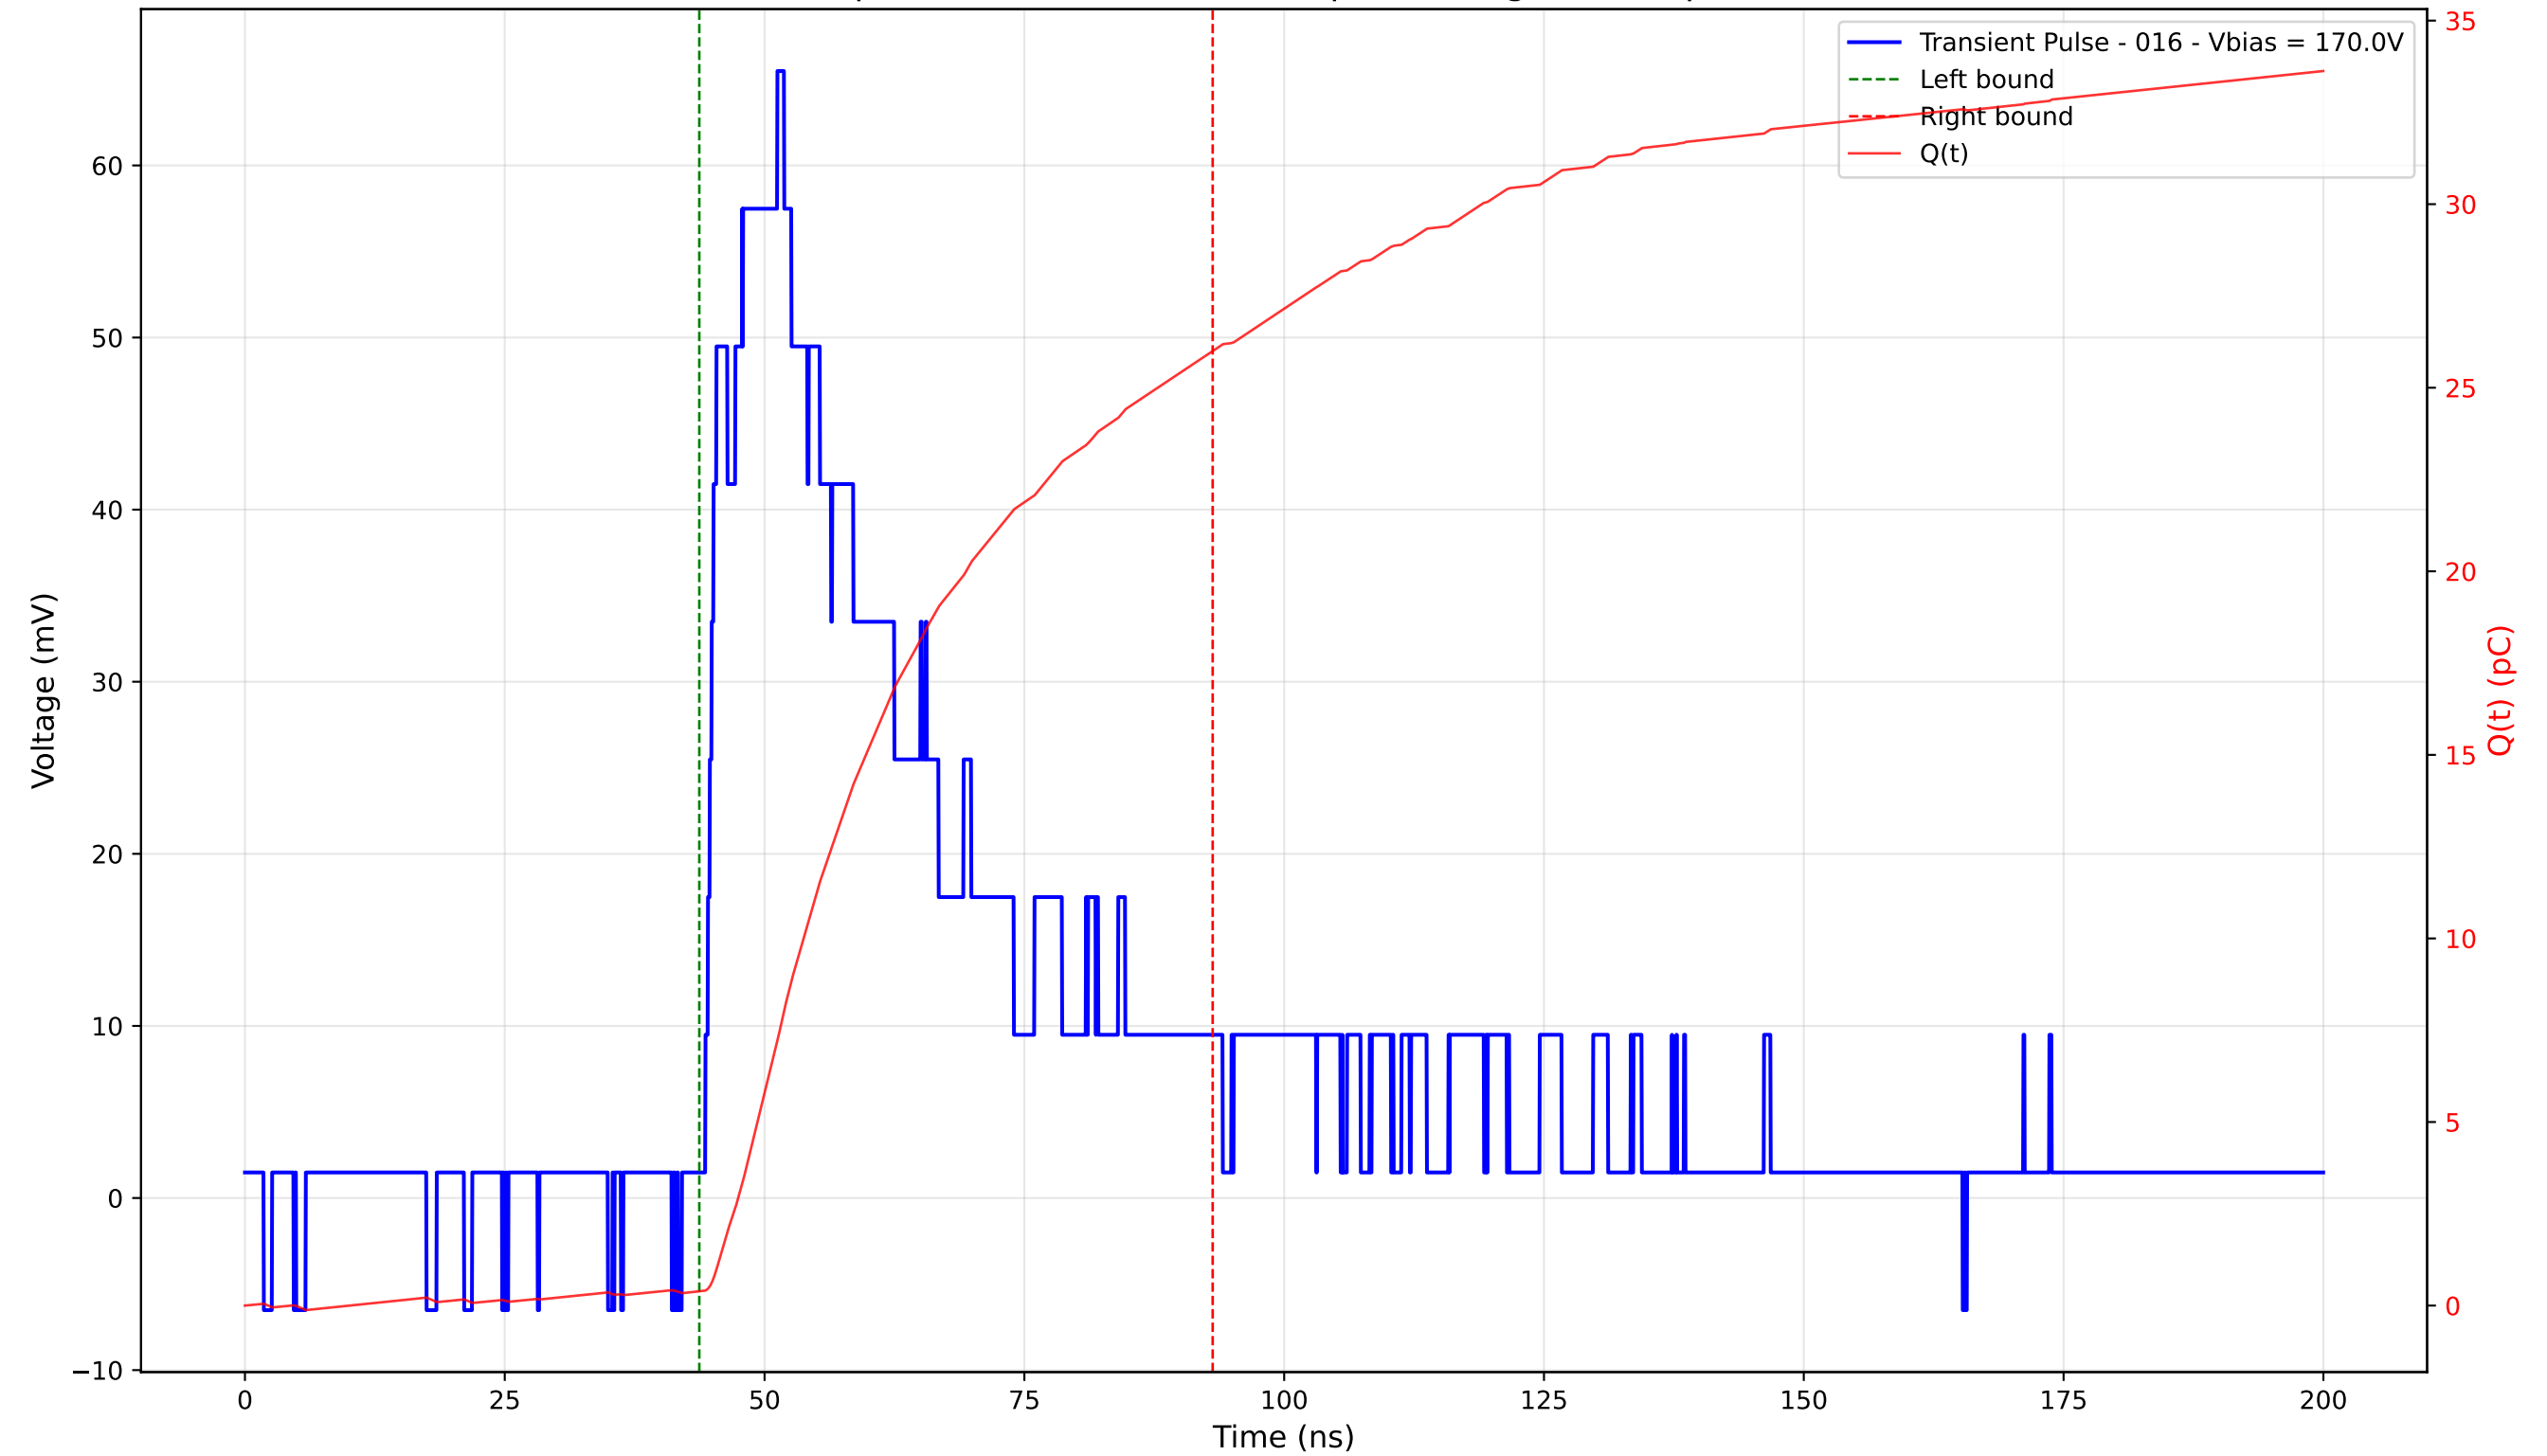


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 20.29 pC - Rise Time: 1.16 ns

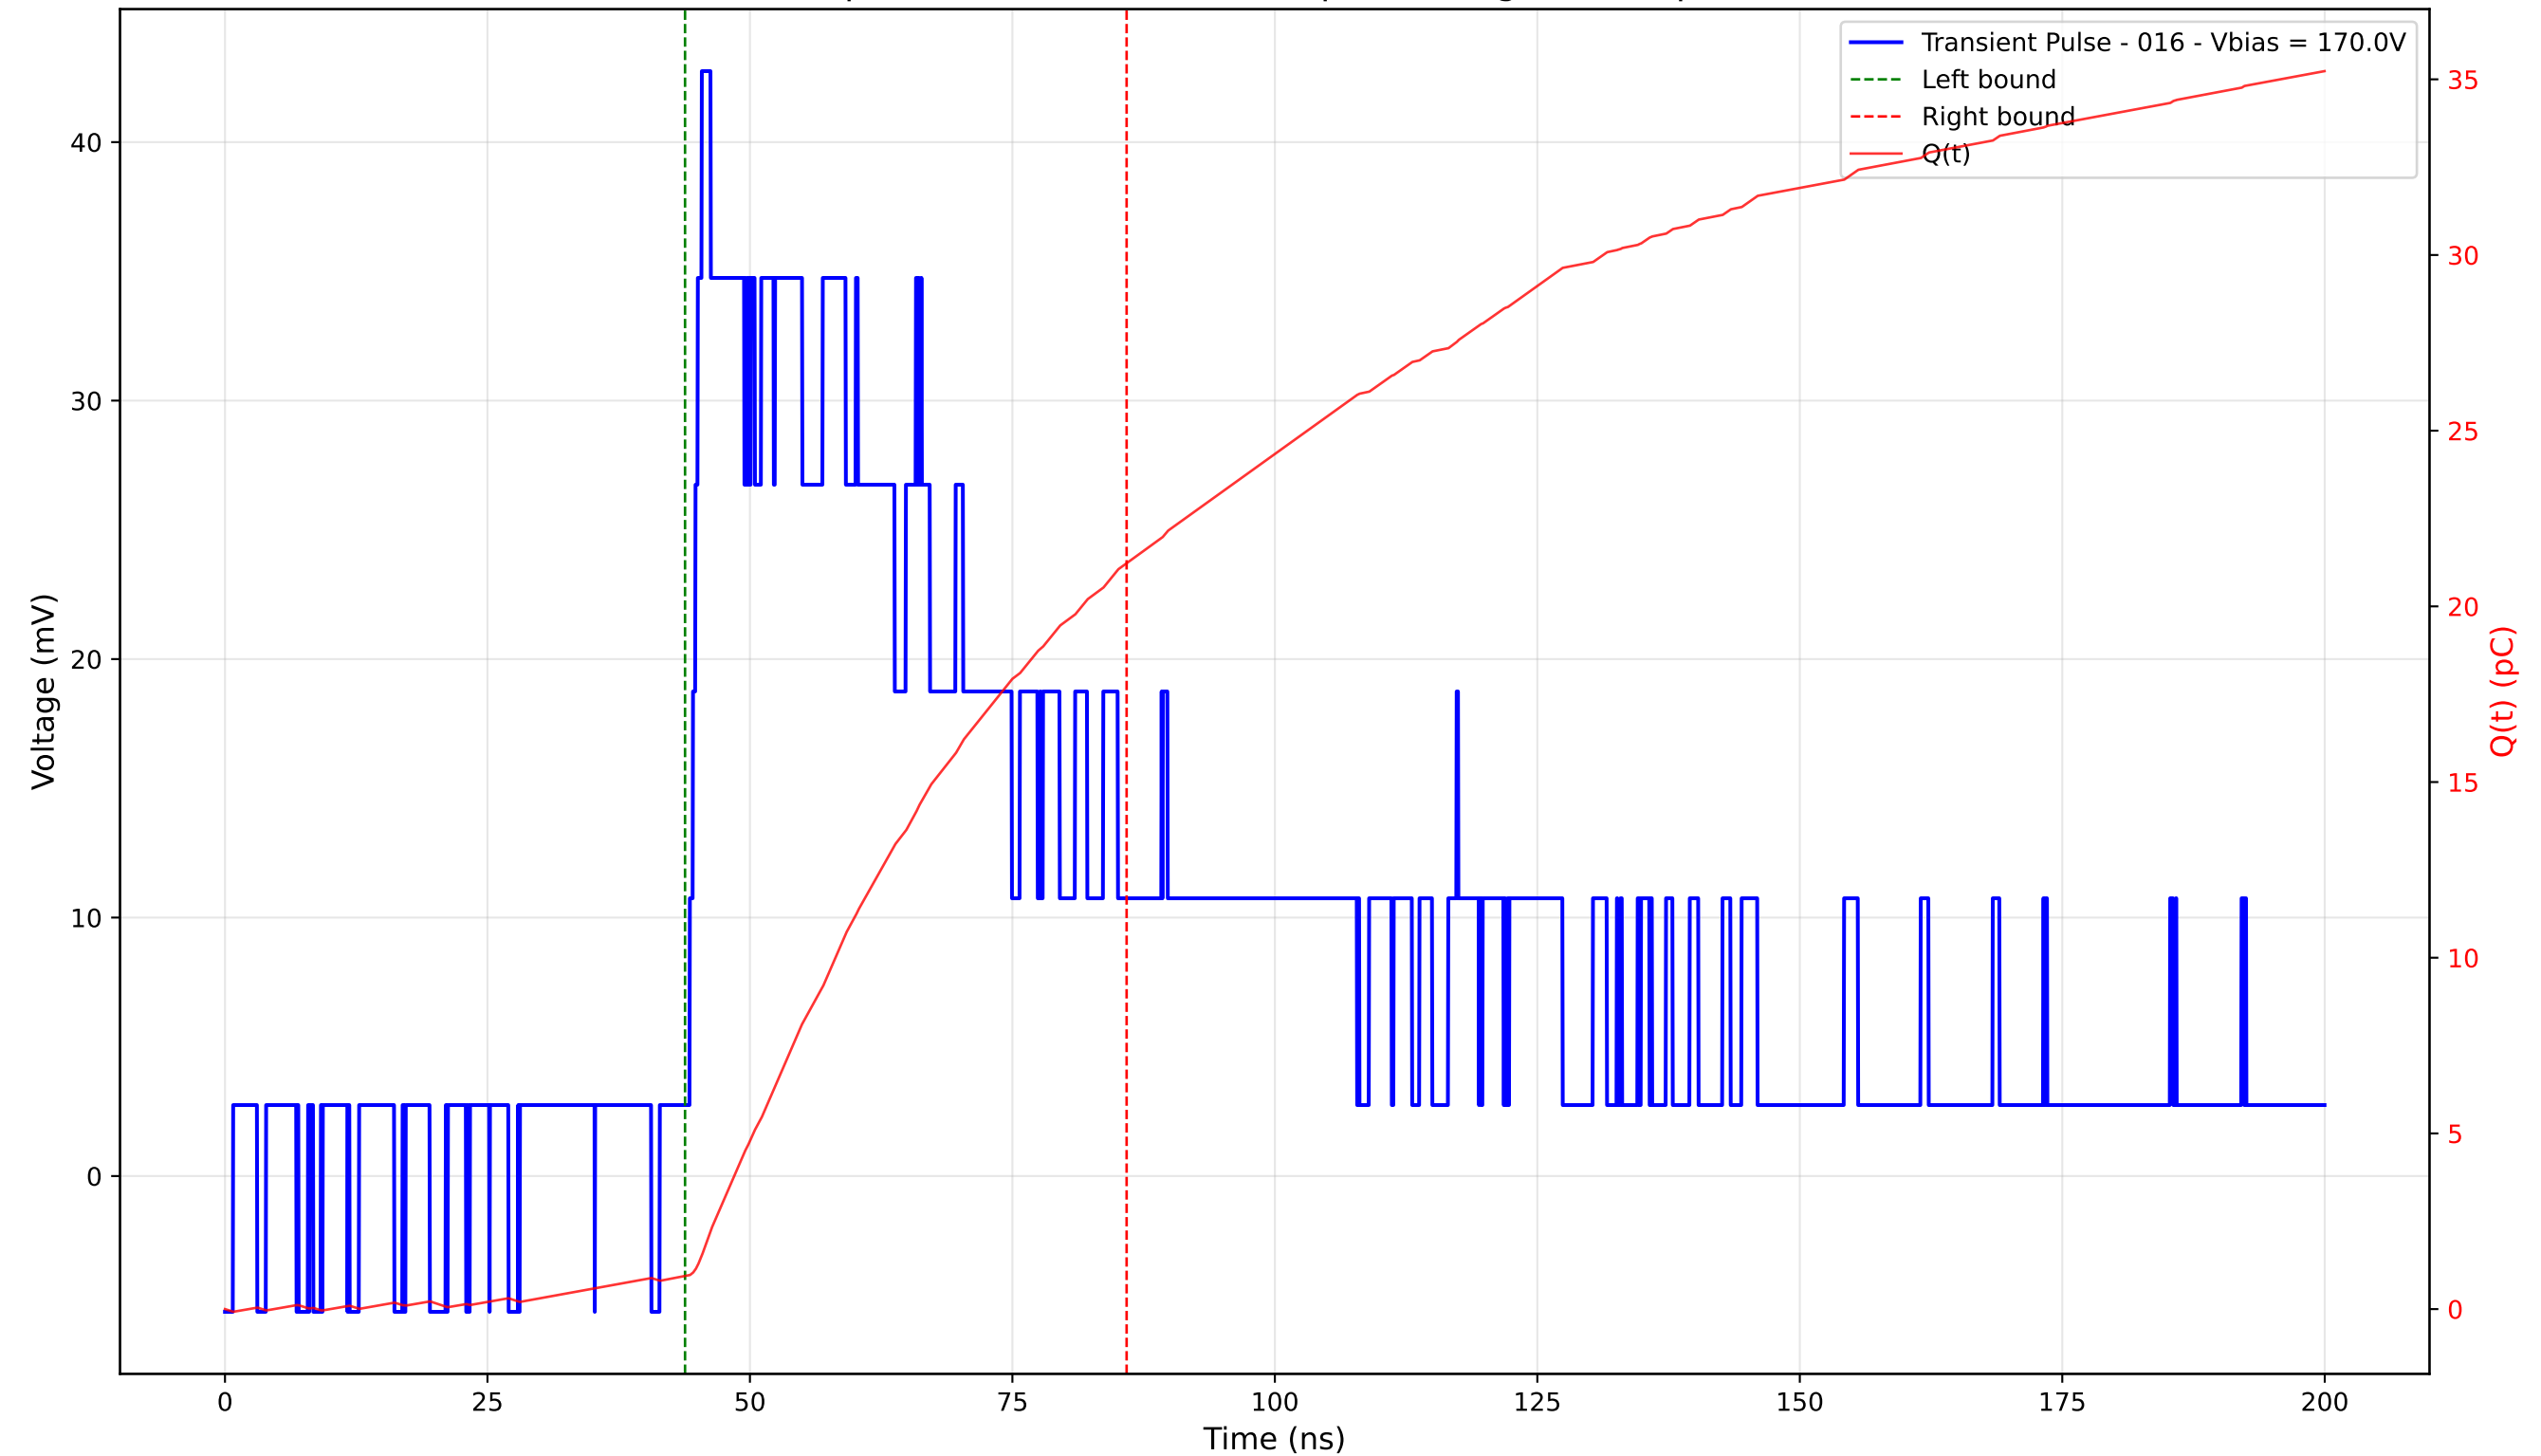


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 13.89 pC - Rise Time: 0.86 ns

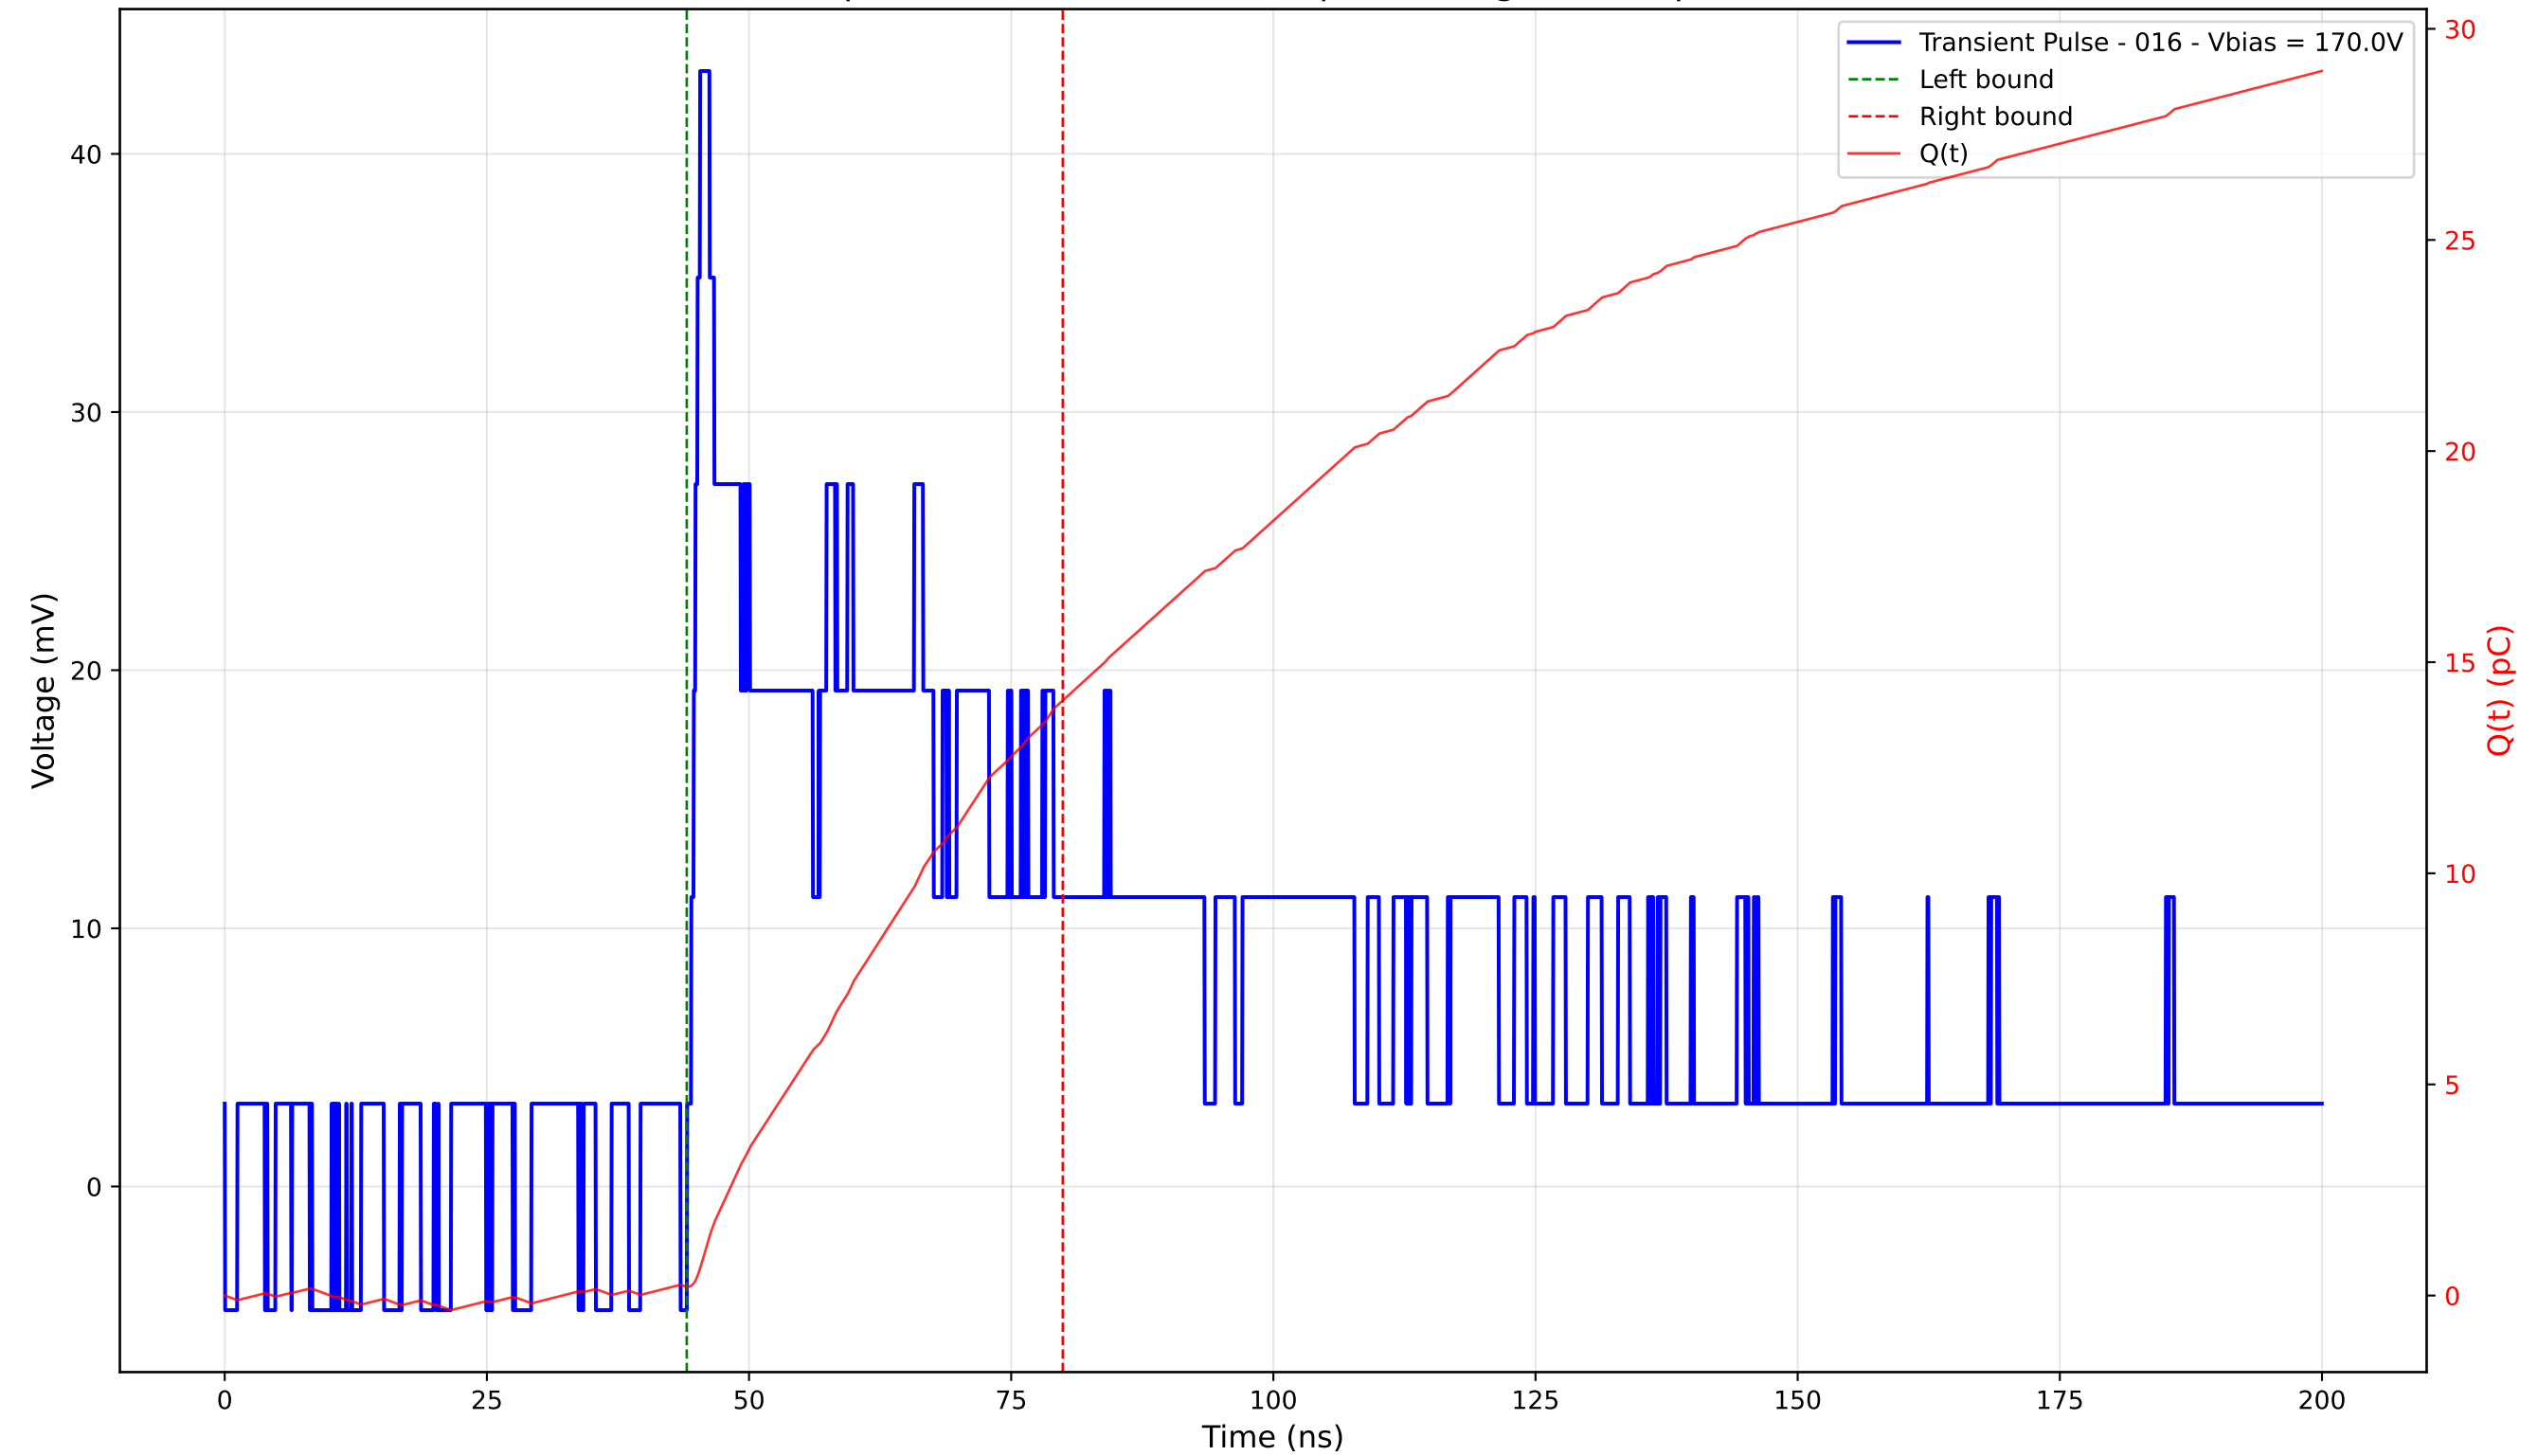


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 4.29 pC - Rise Time: 1.14 ns

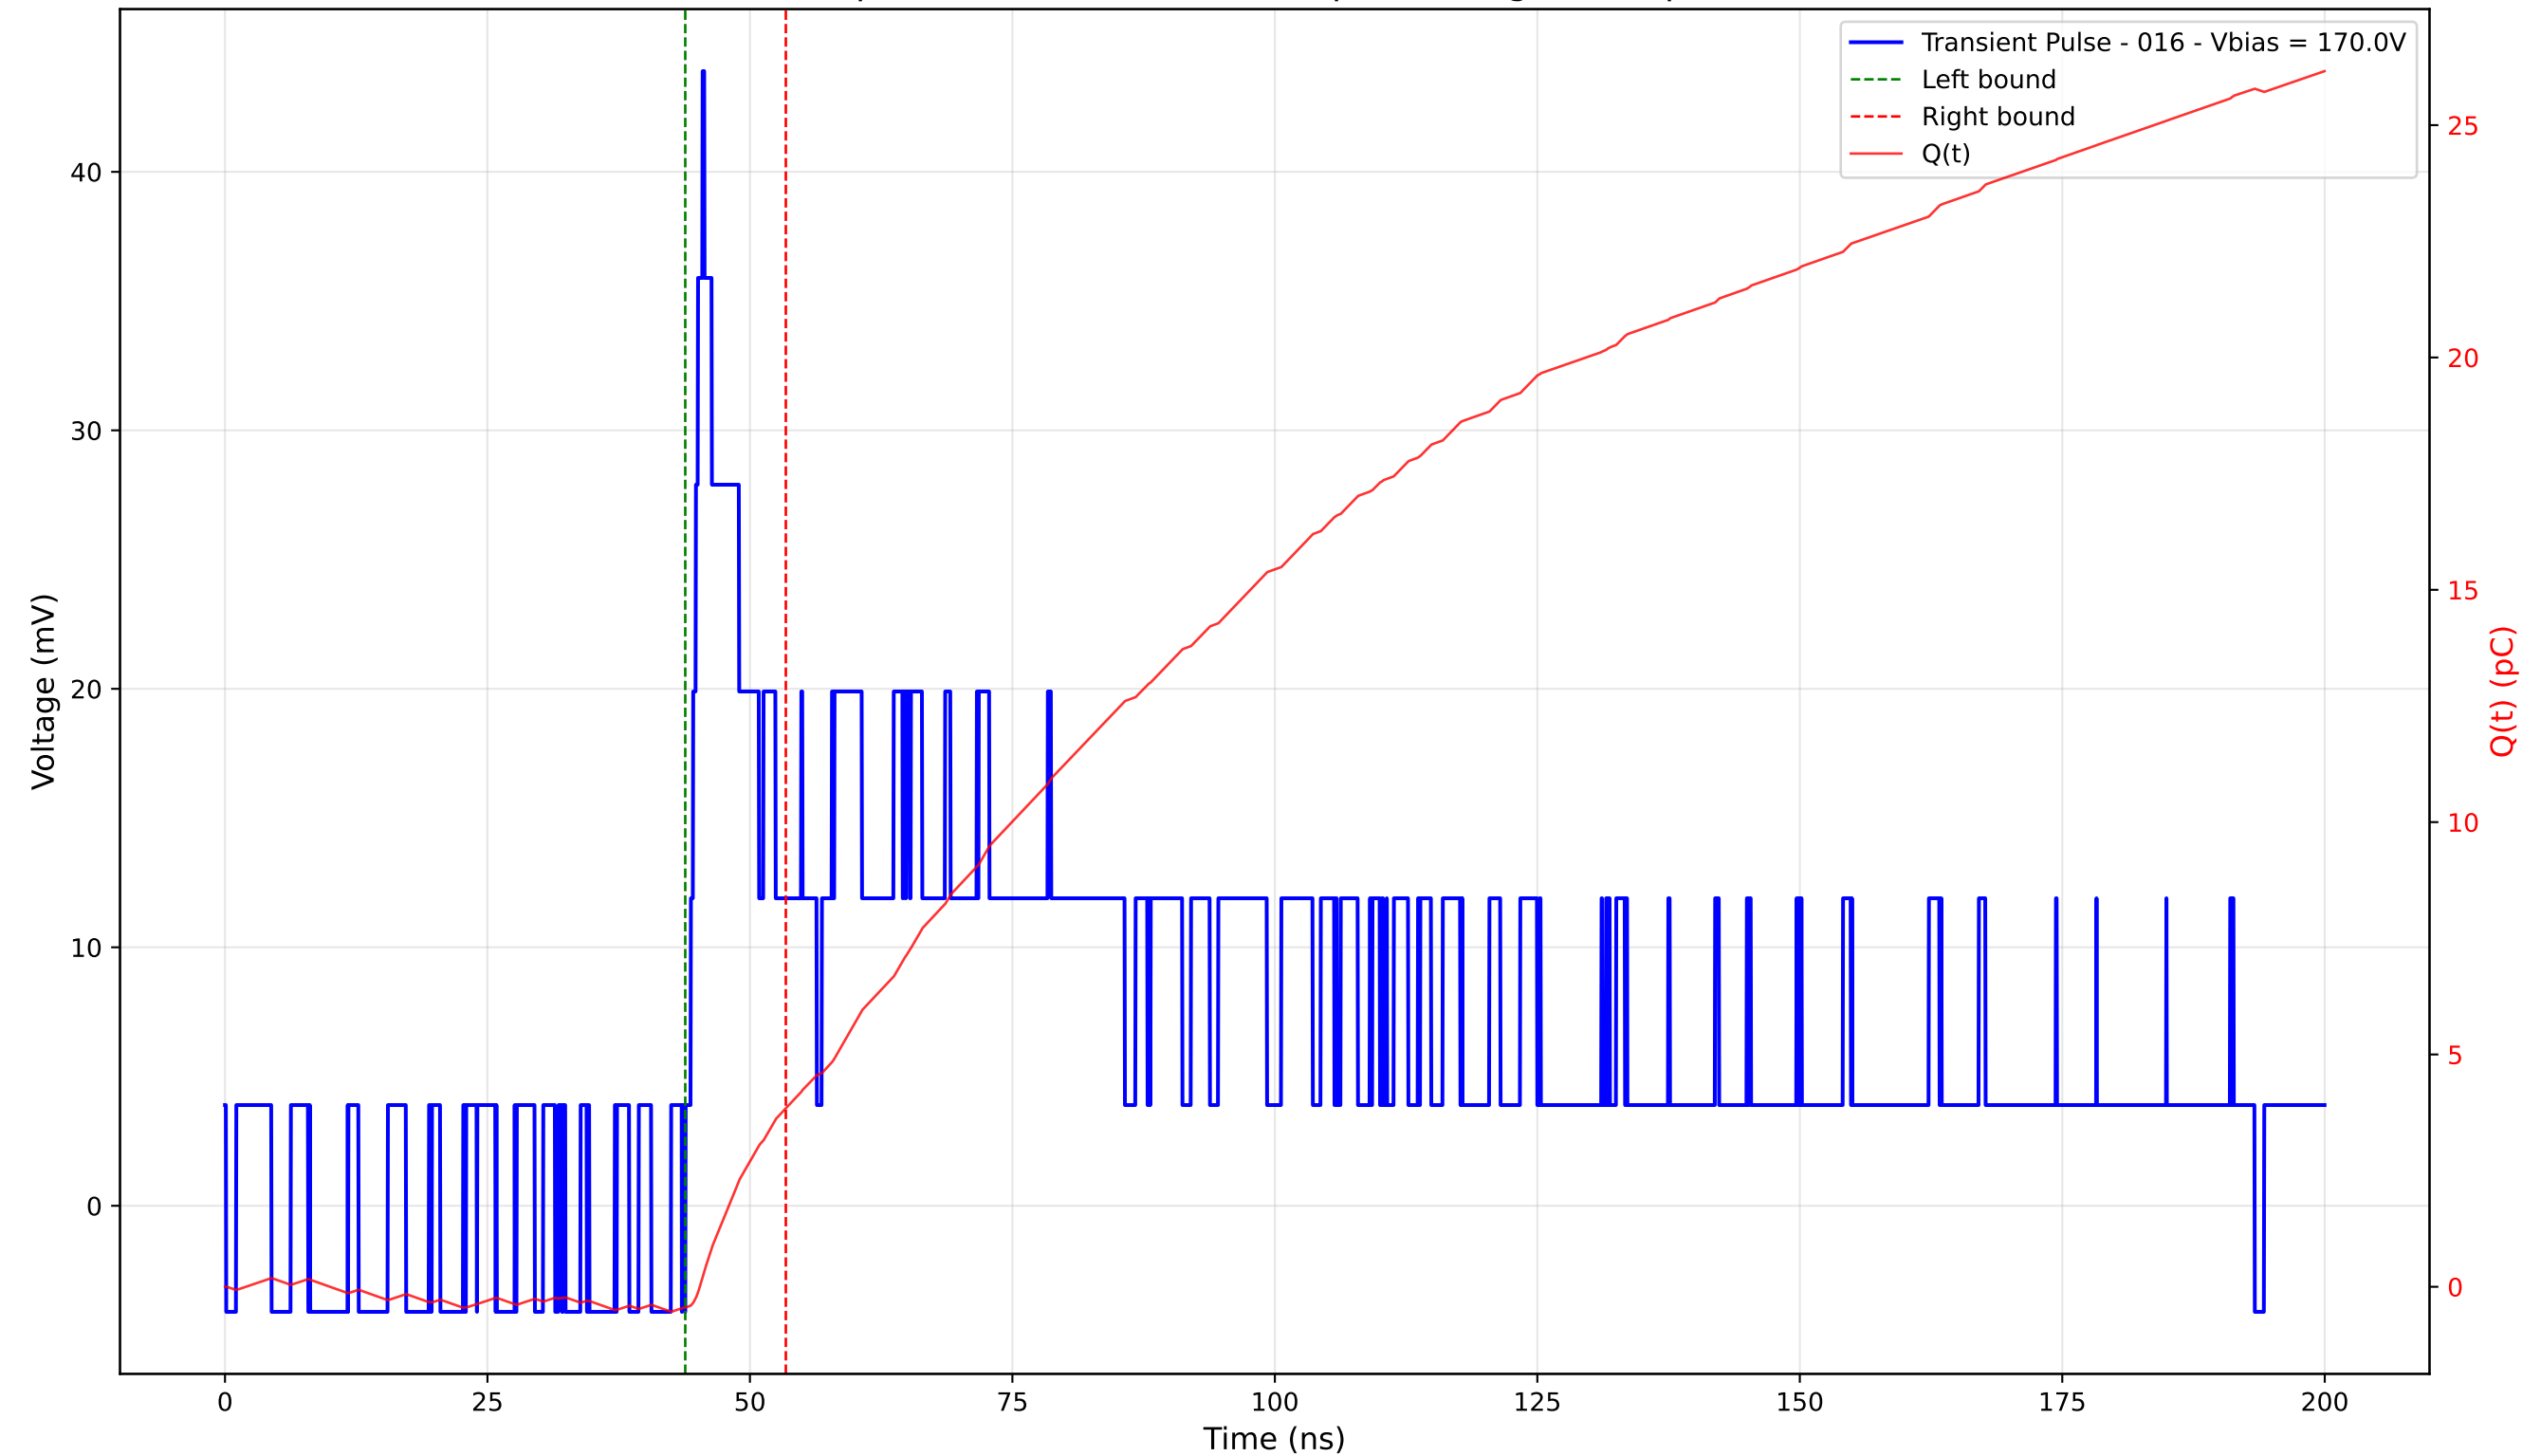


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 3.68 pC - Rise Time: 0.00 ns (N/A)

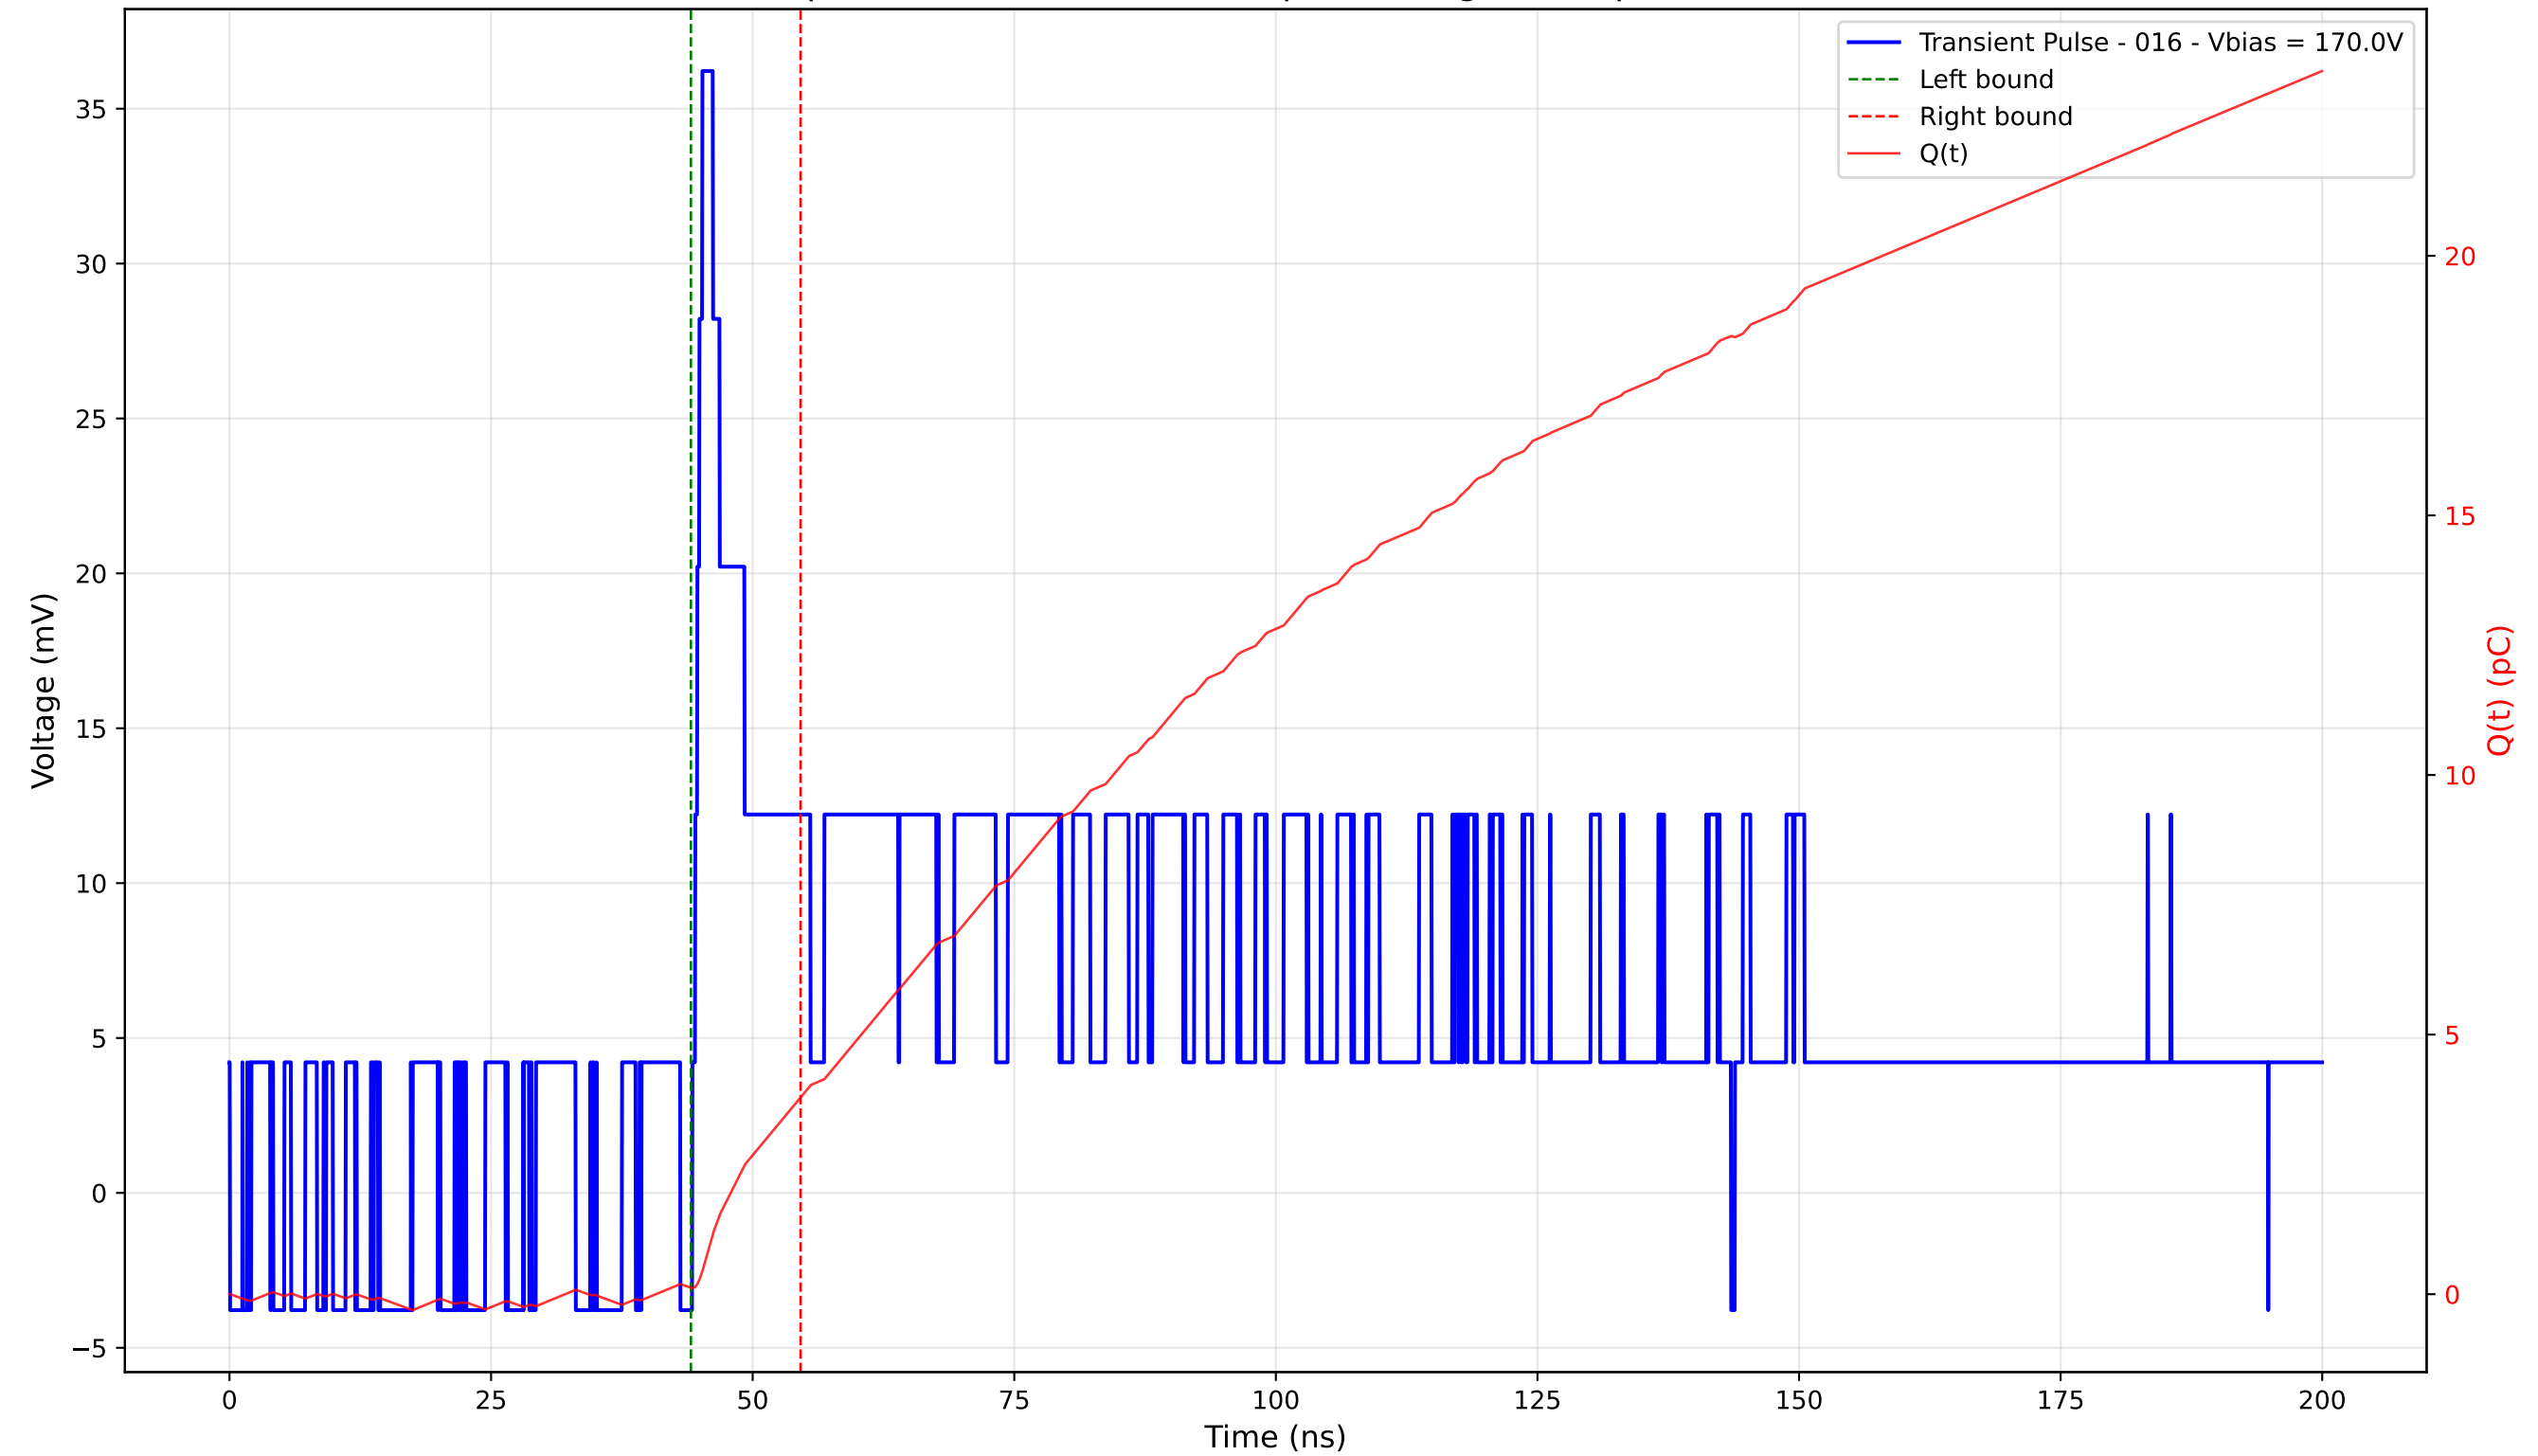


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 2.35 pC - Rise Time: 0.80 ns

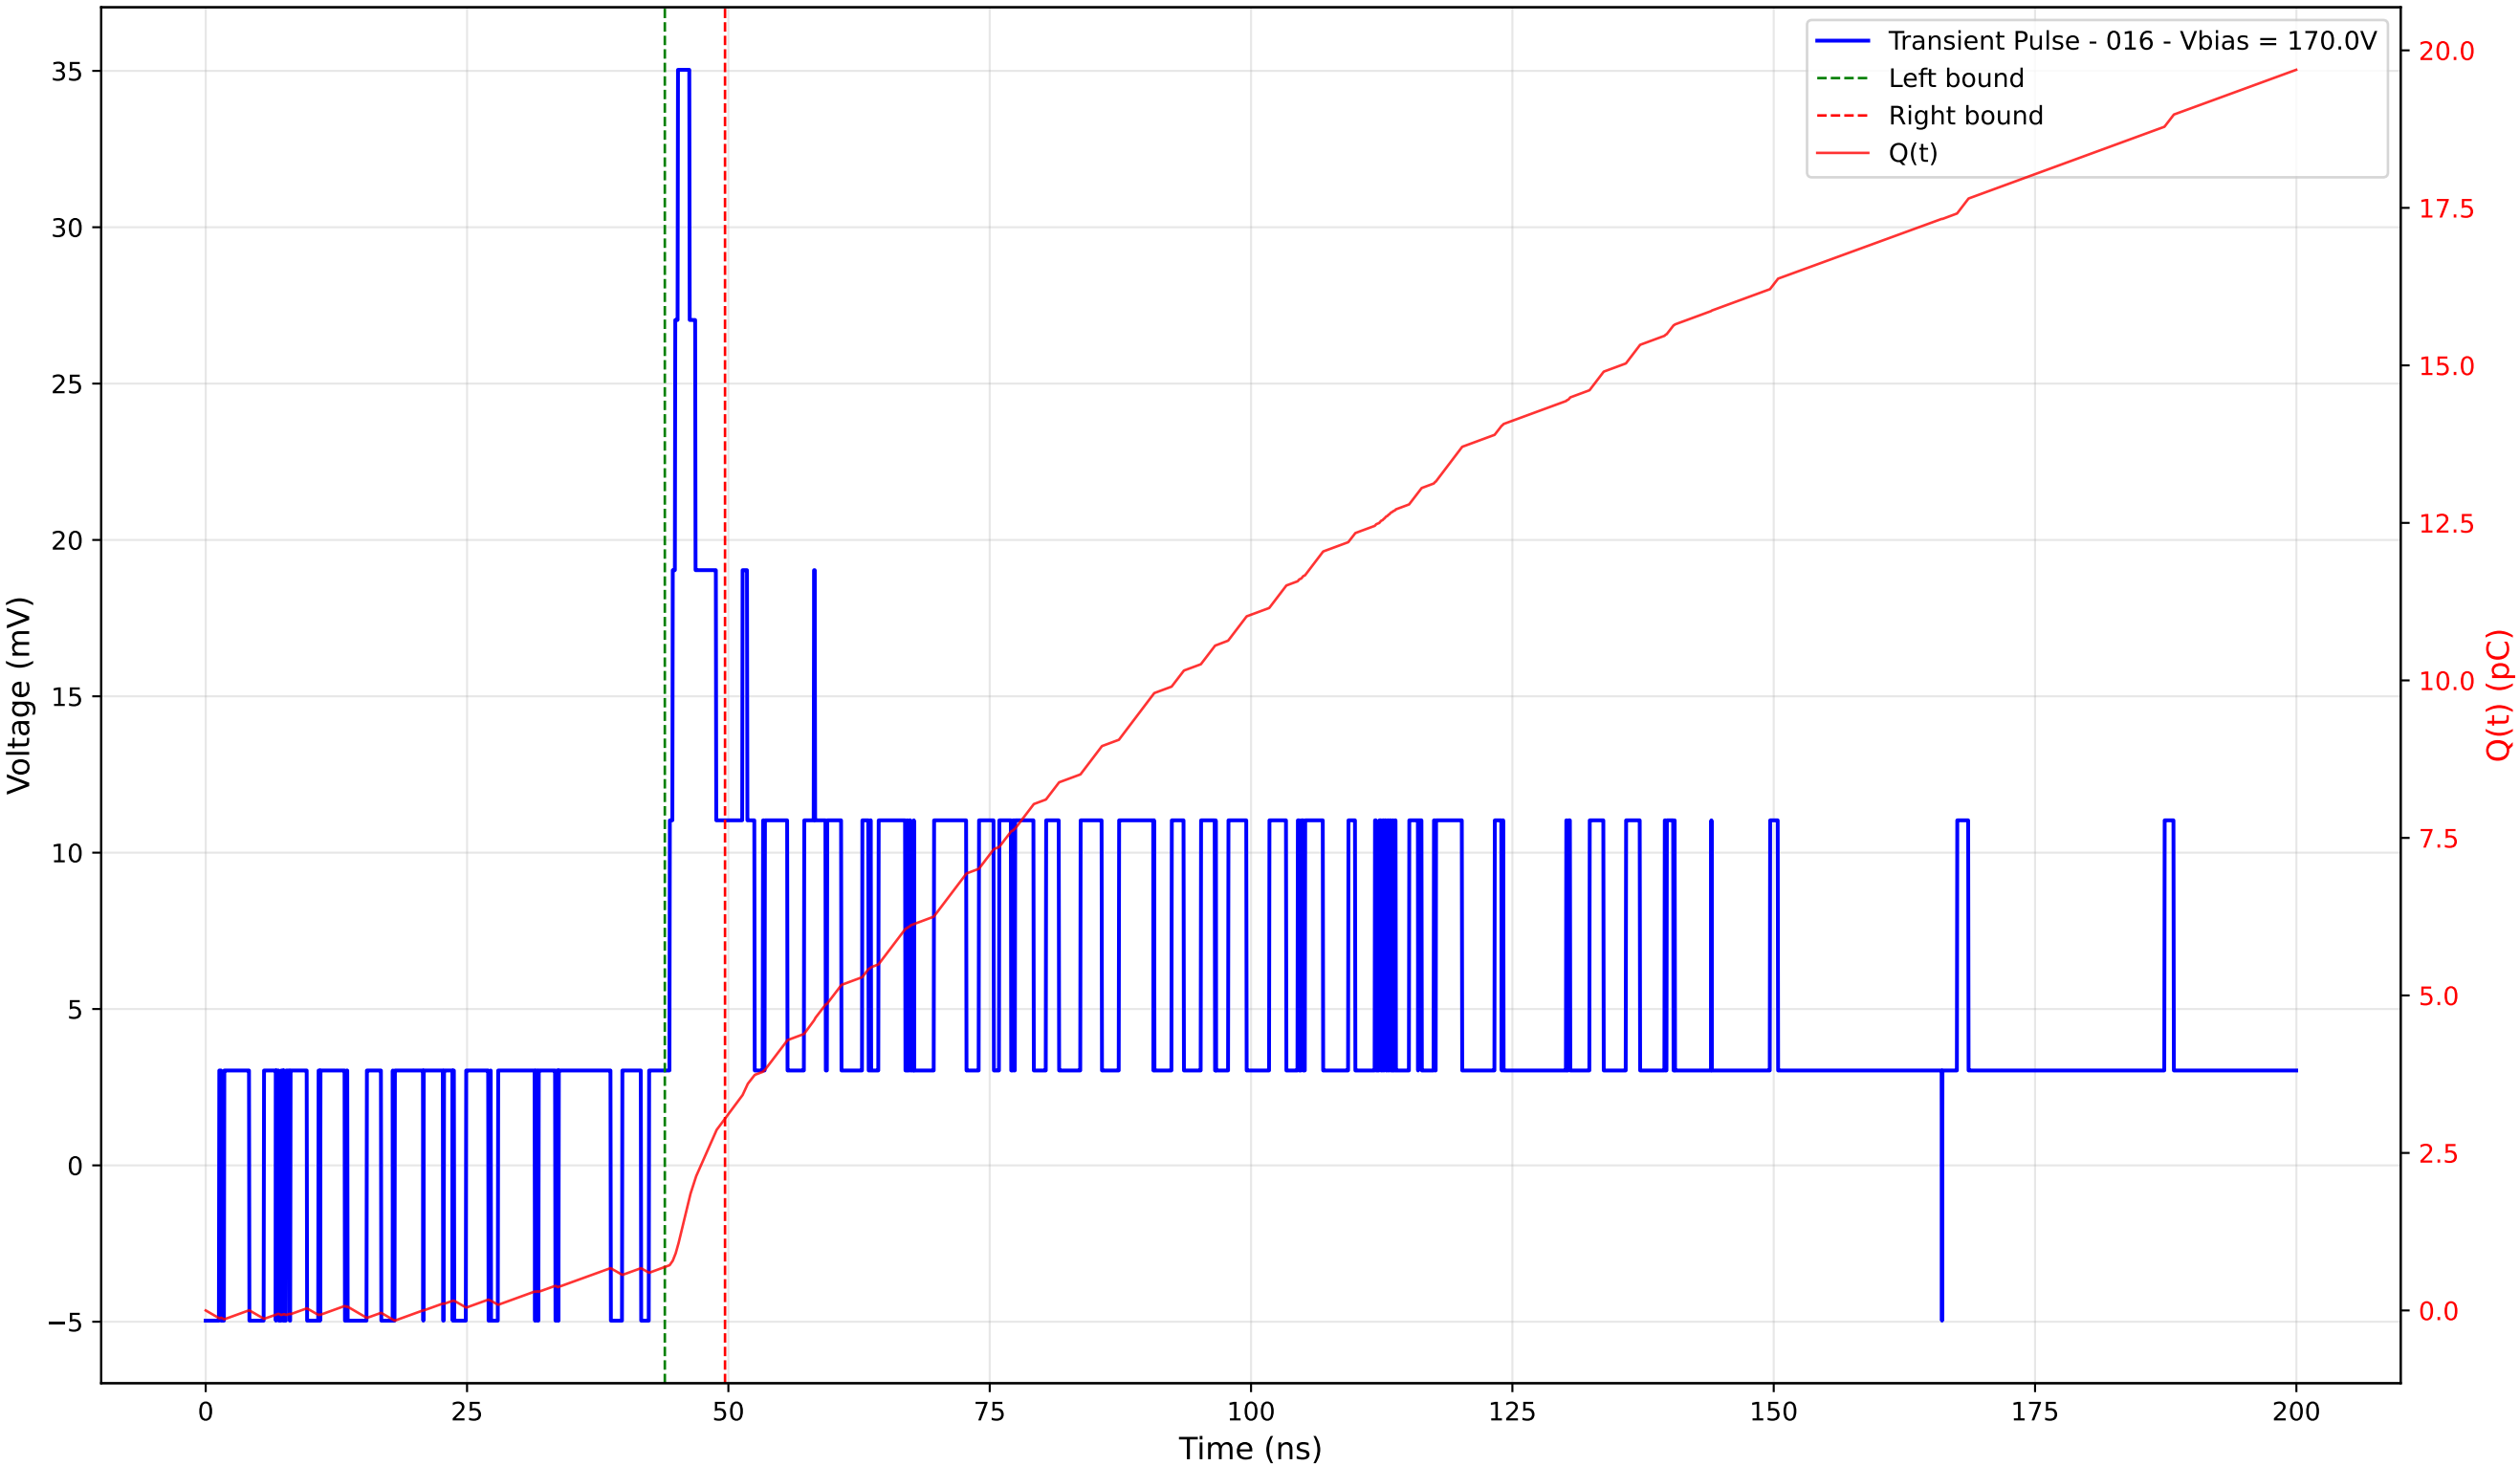


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 2.25 pC - Rise Time: 0.72 ns

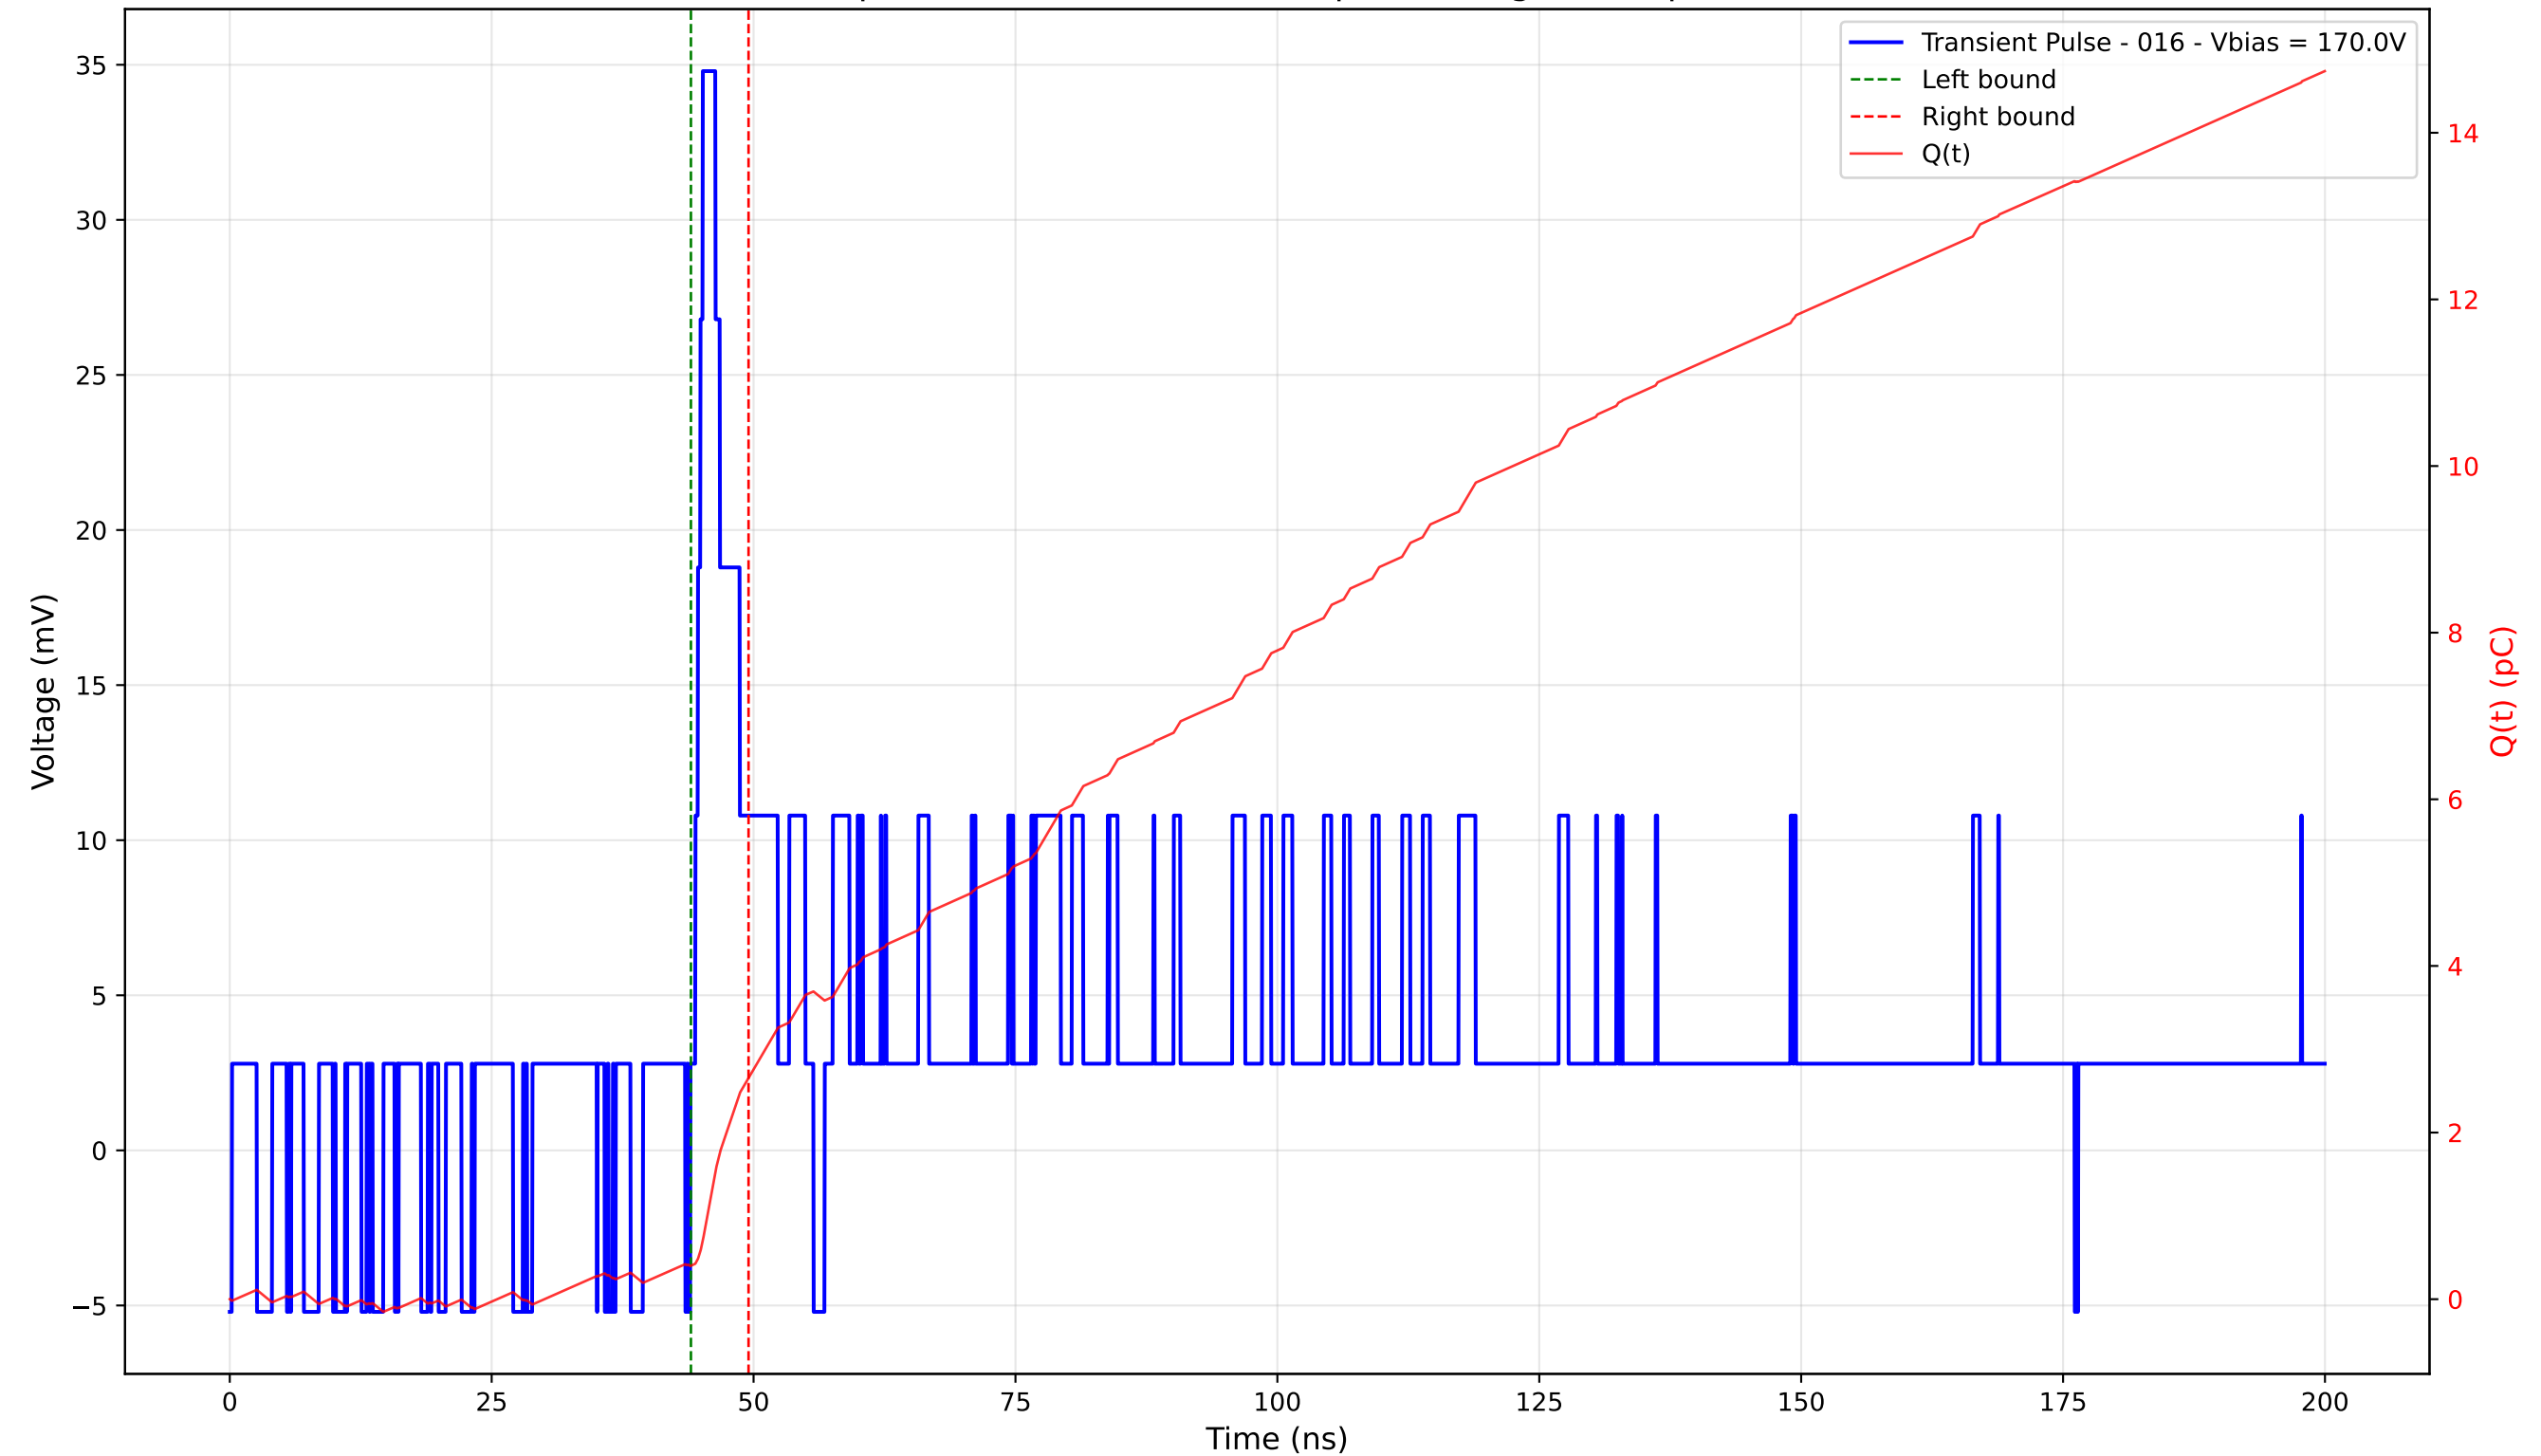


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 2.34 pC - Rise Time: 0.86 ns

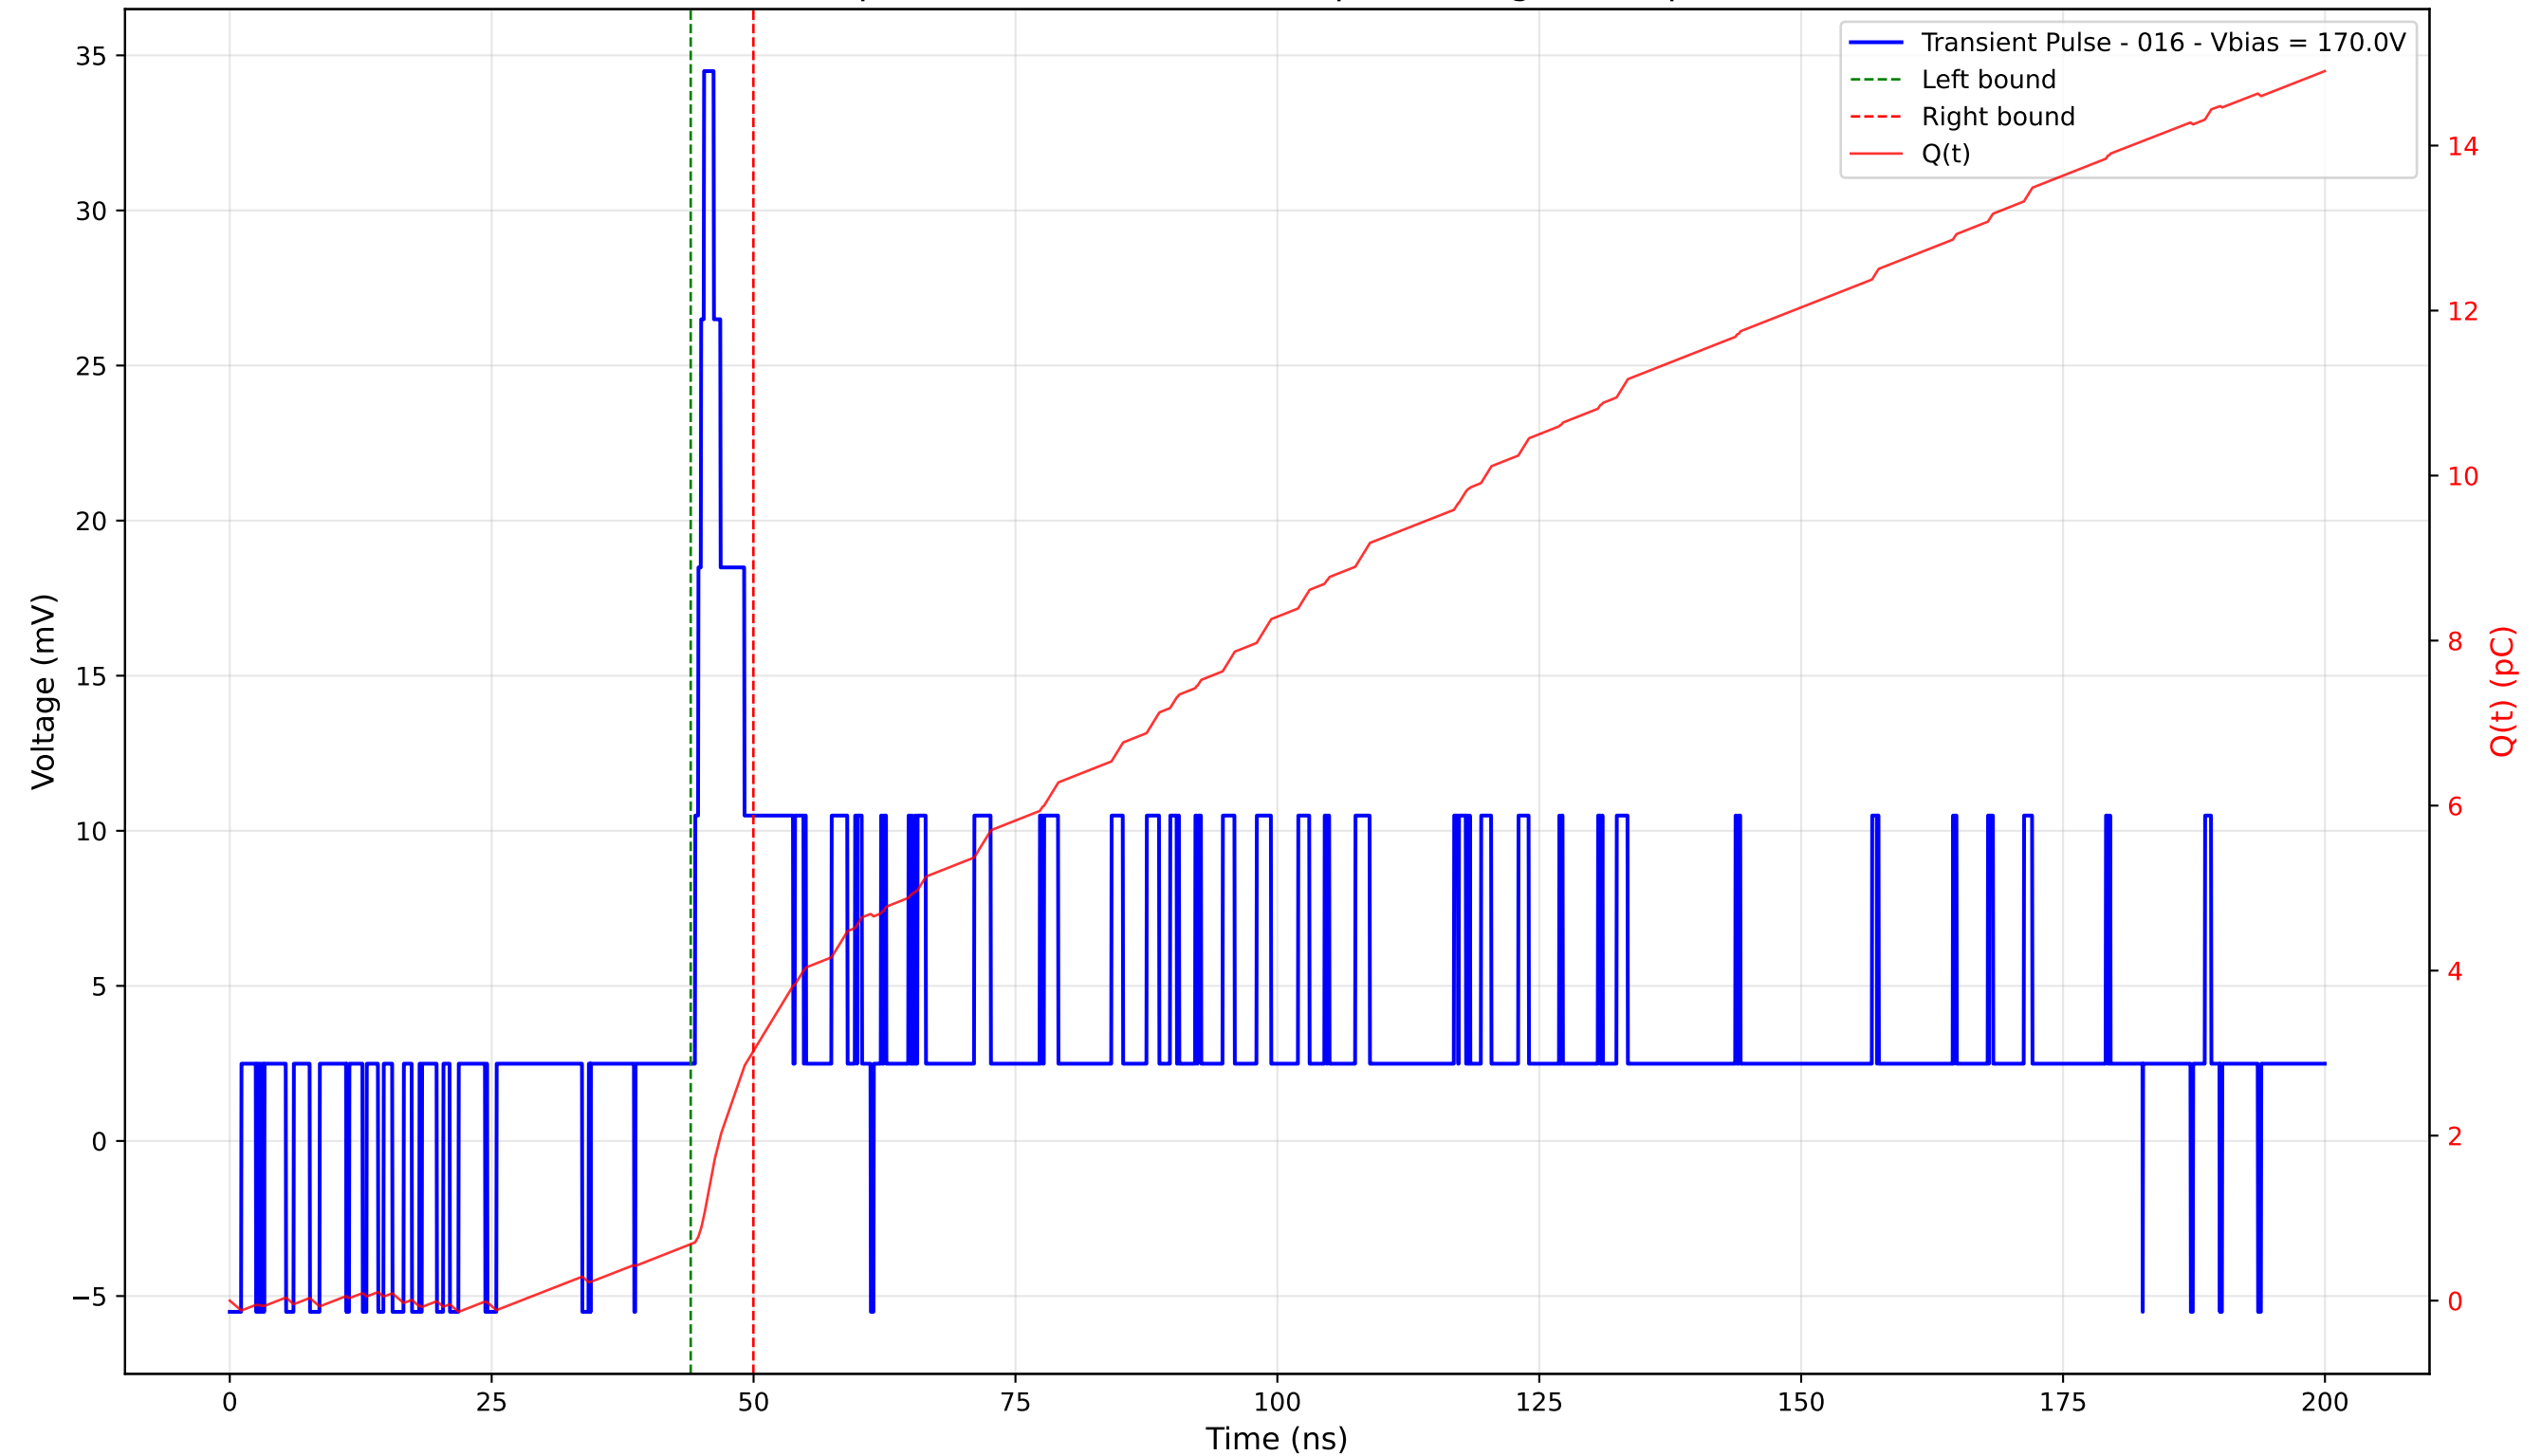


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 3.05 pC - Rise Time: 1.27 ns

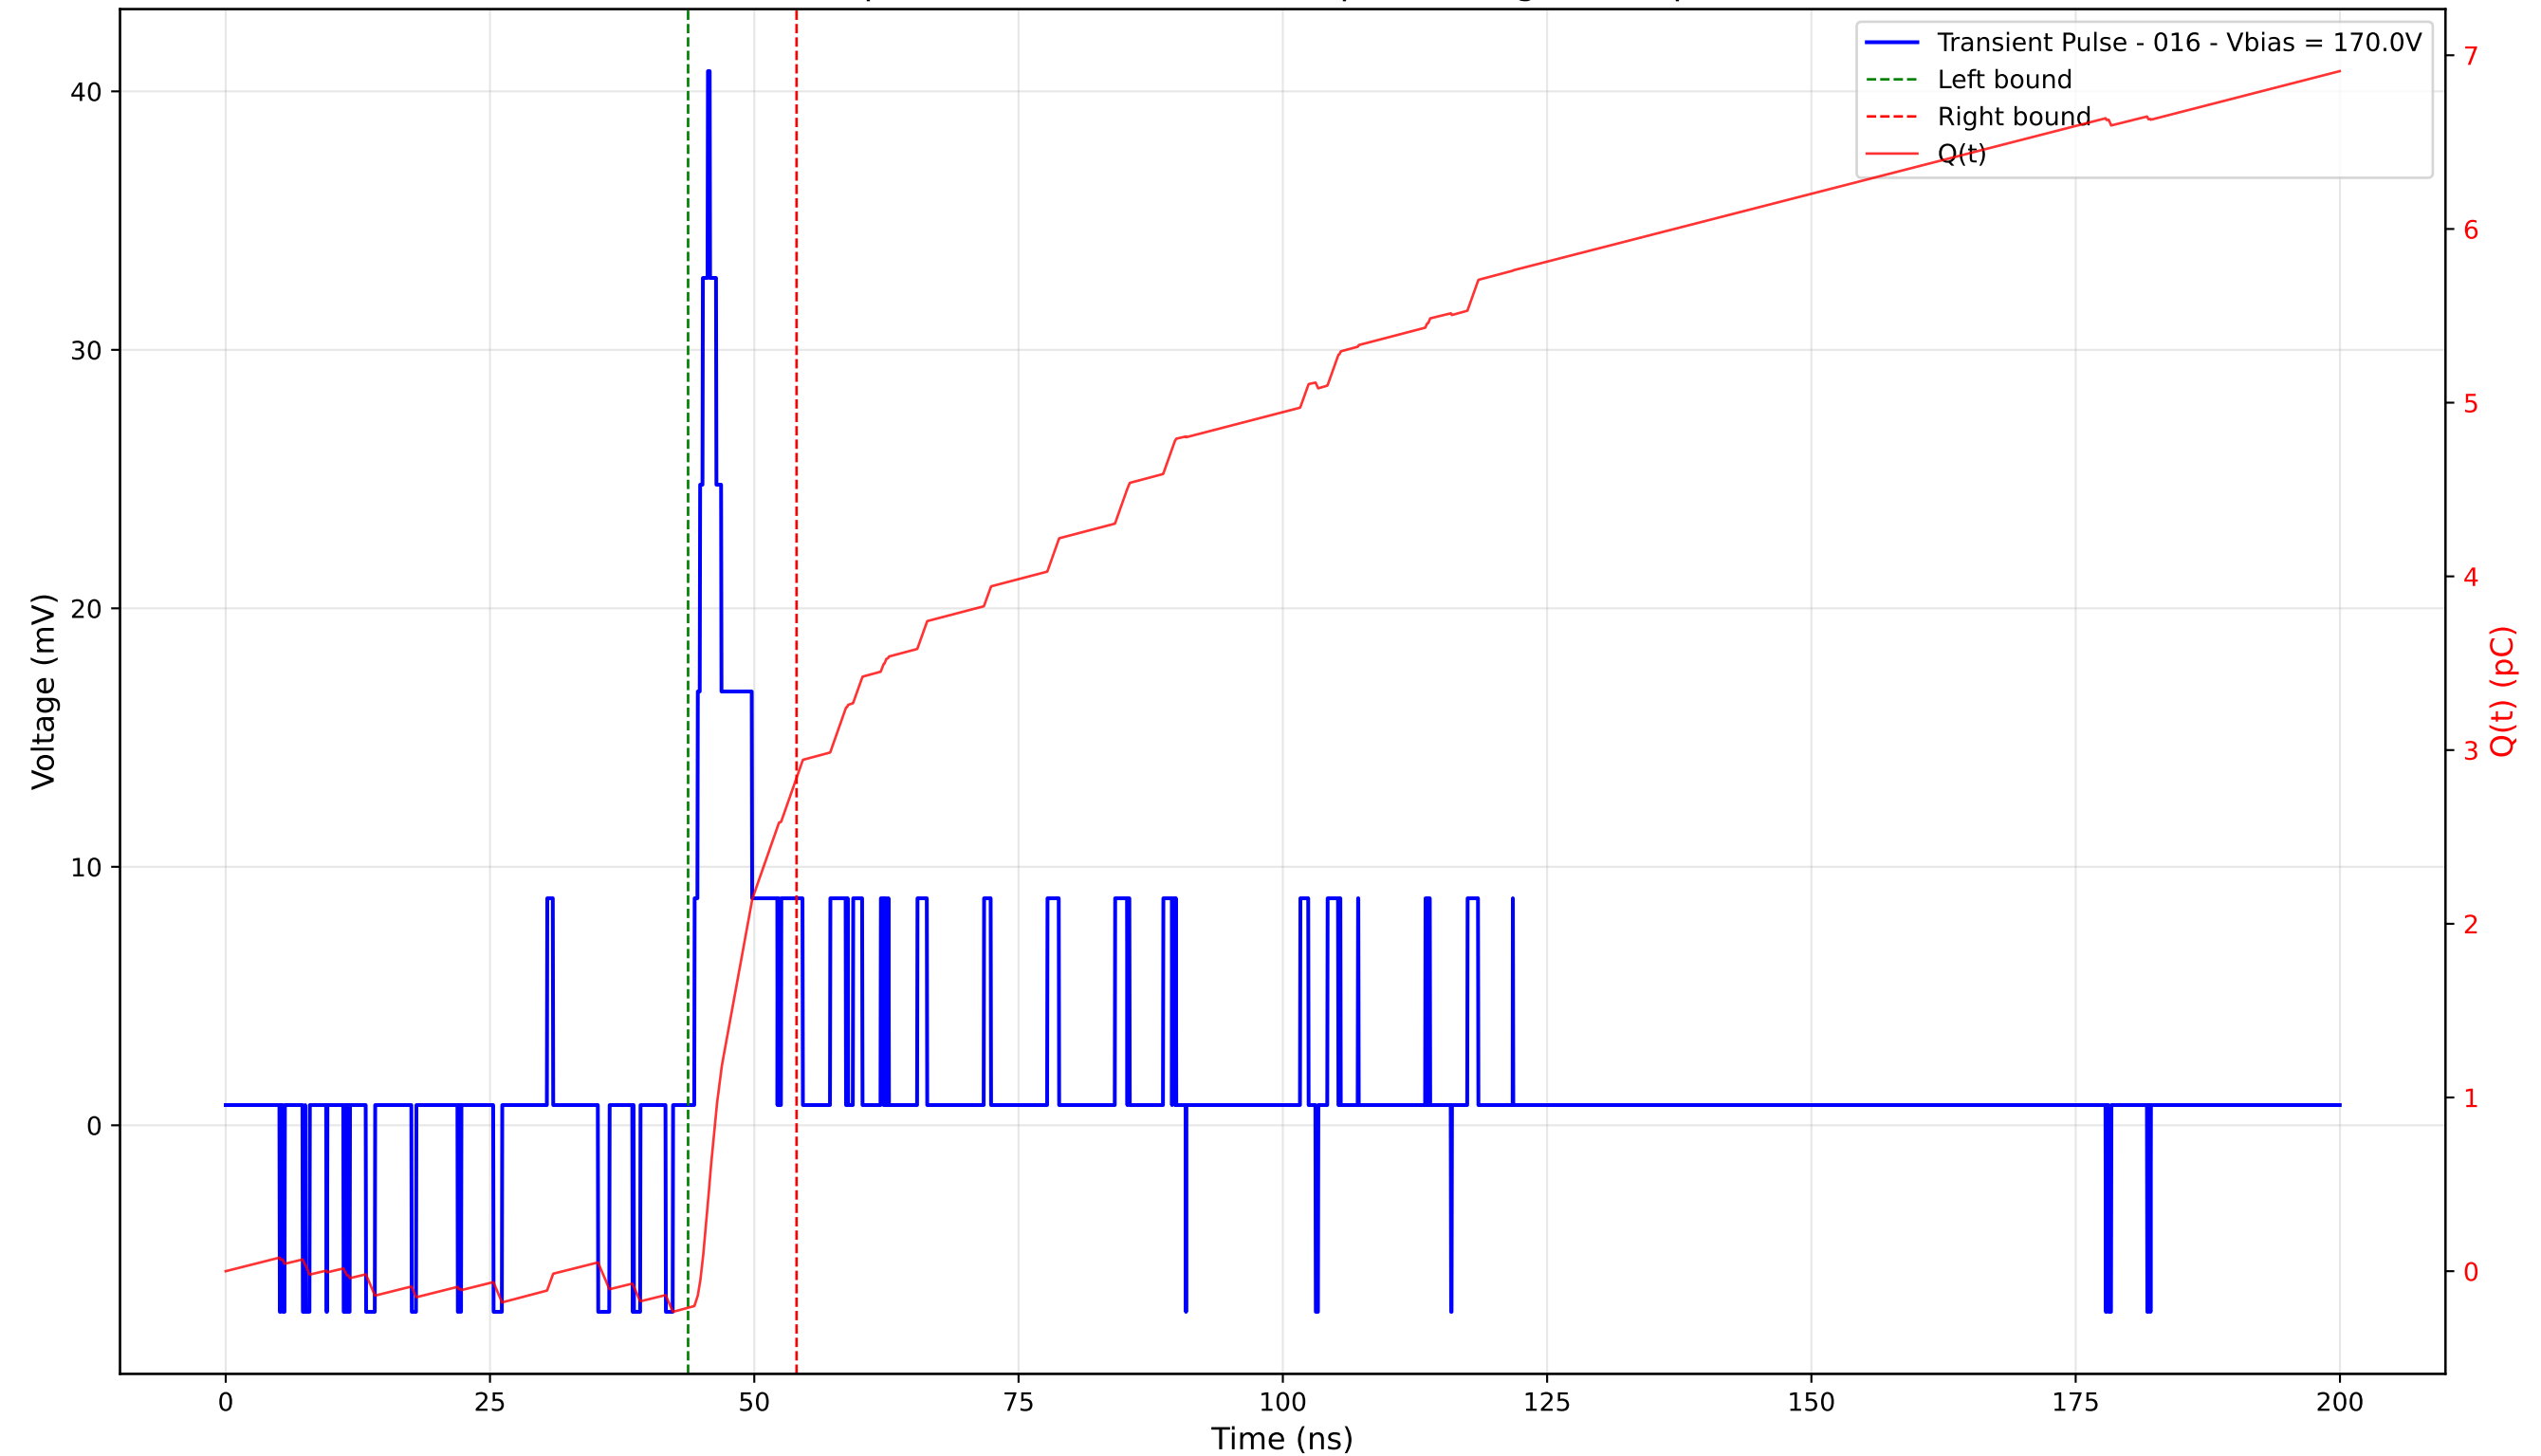


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 2.61 pC - Rise Time: 0.76 ns

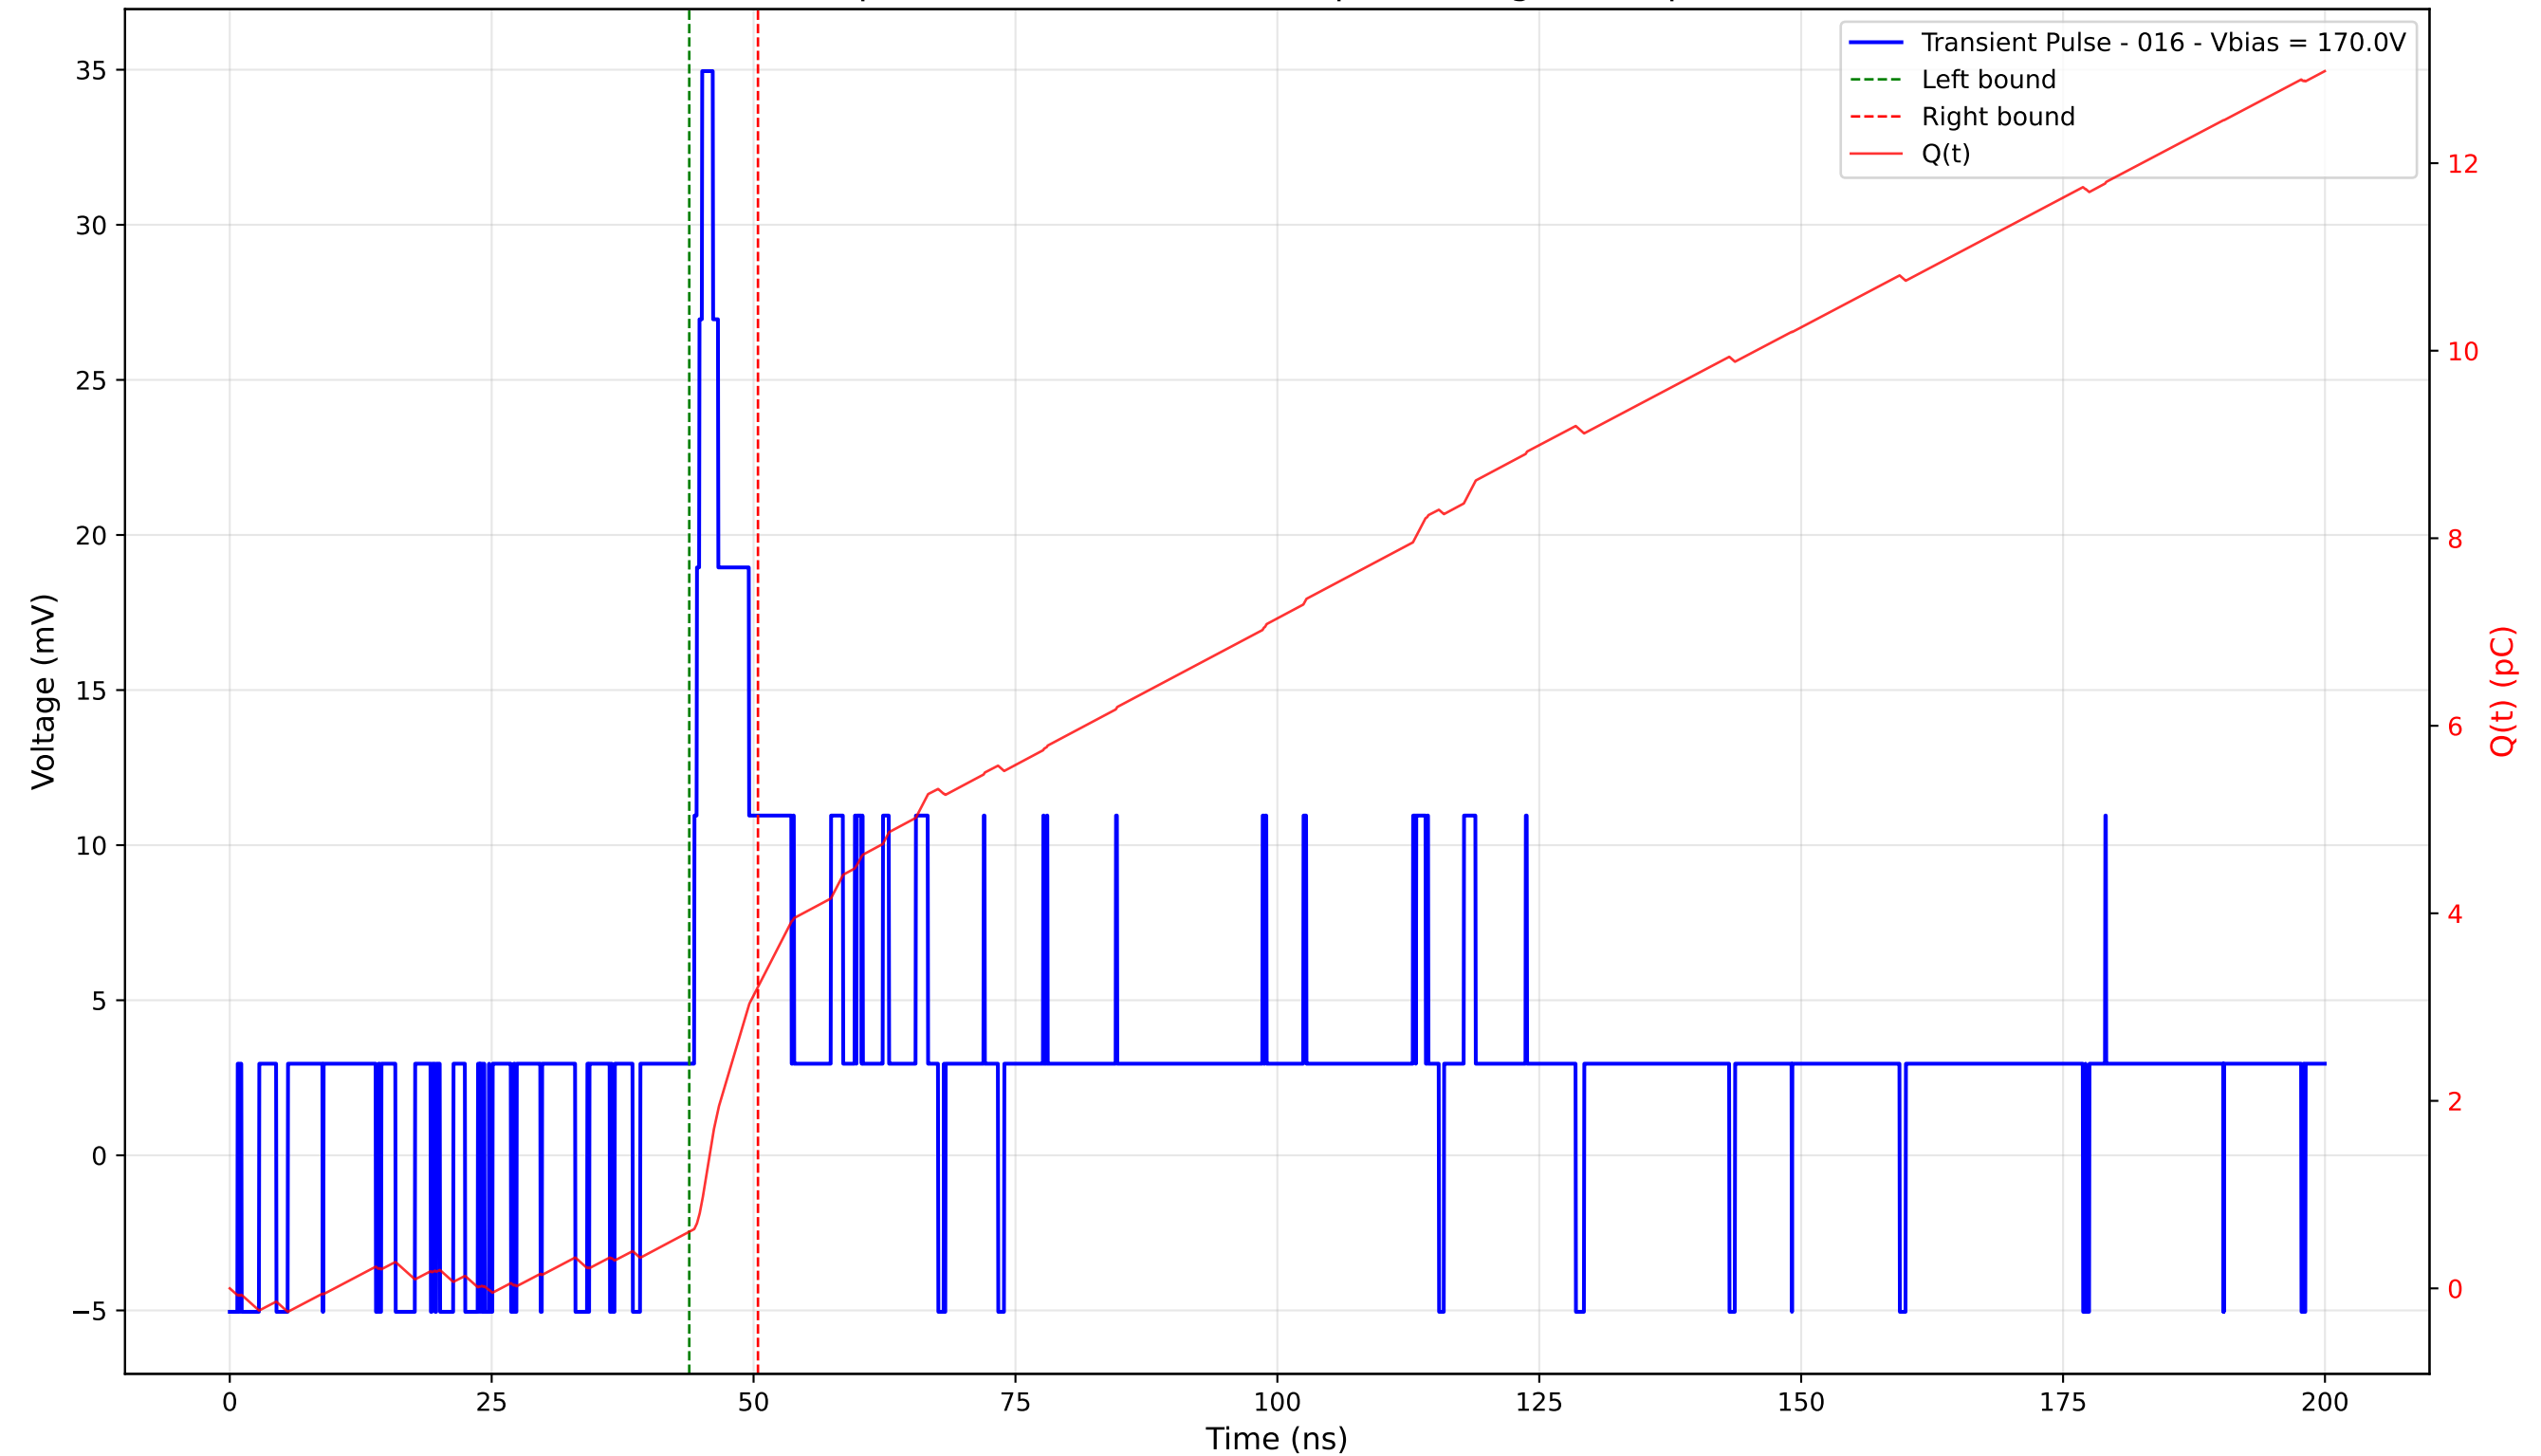


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.52 pC - Rise Time: 0.81 ns

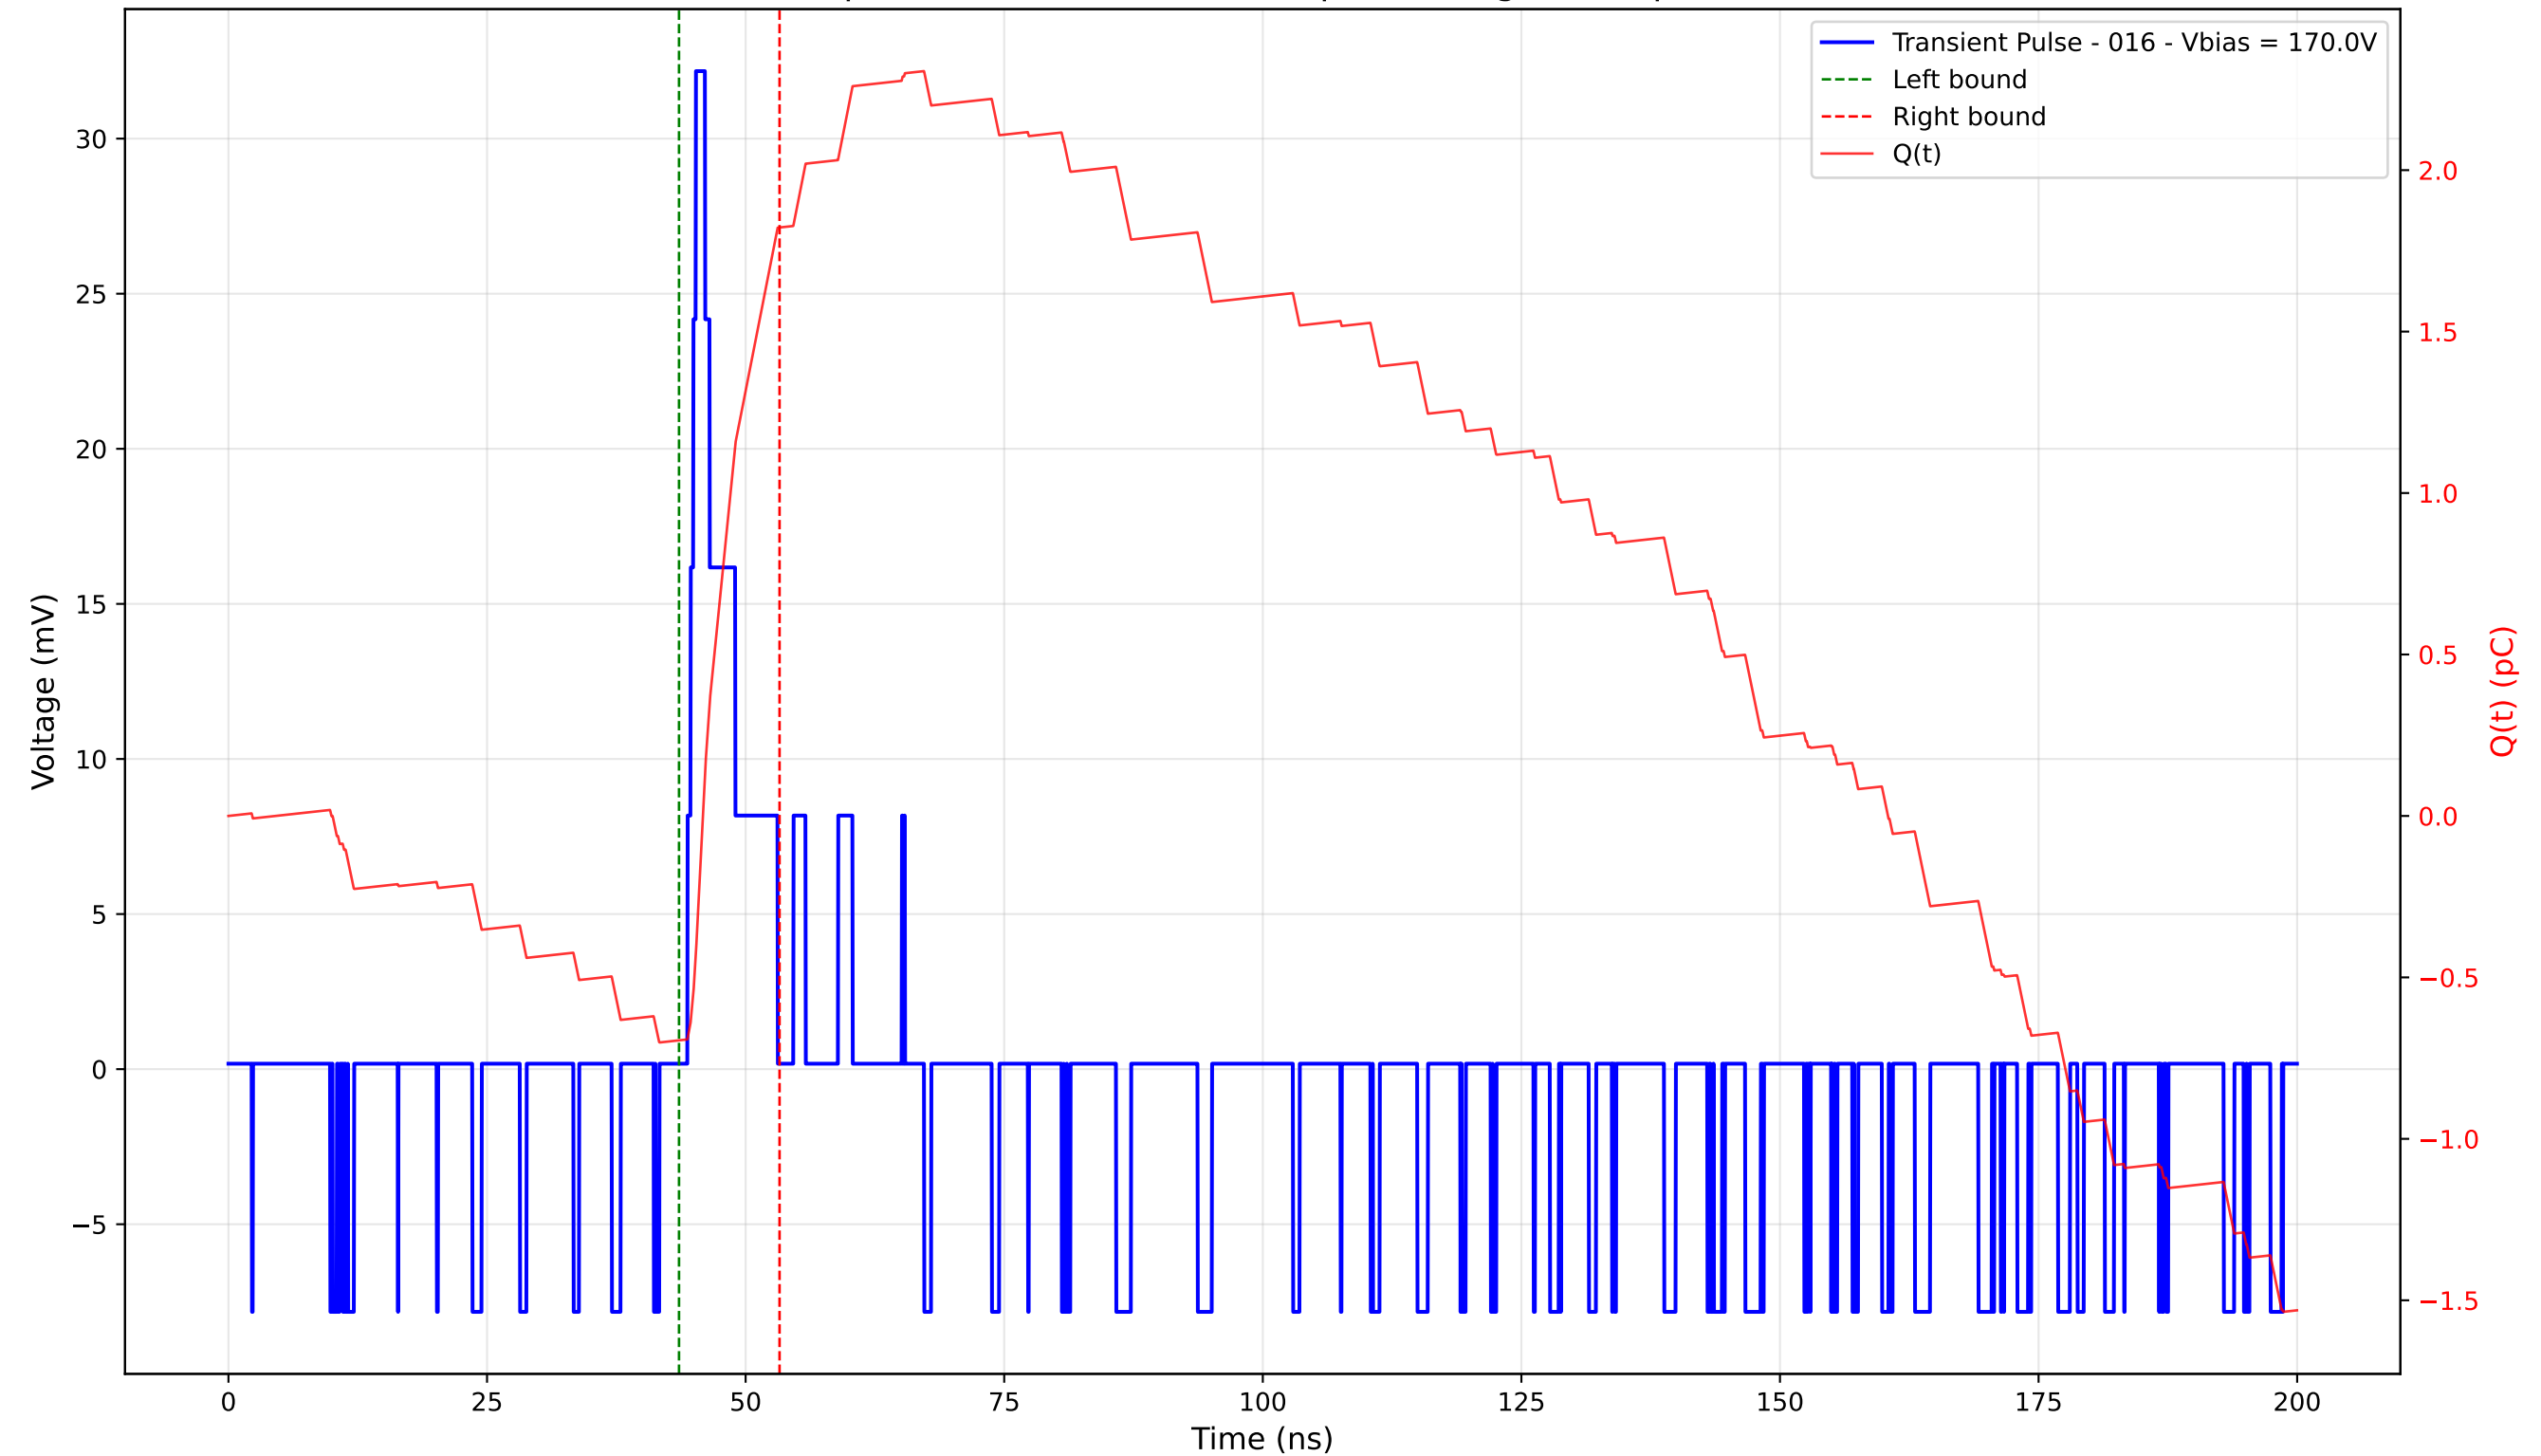


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 2.65 pC - Rise Time: 0.98 ns

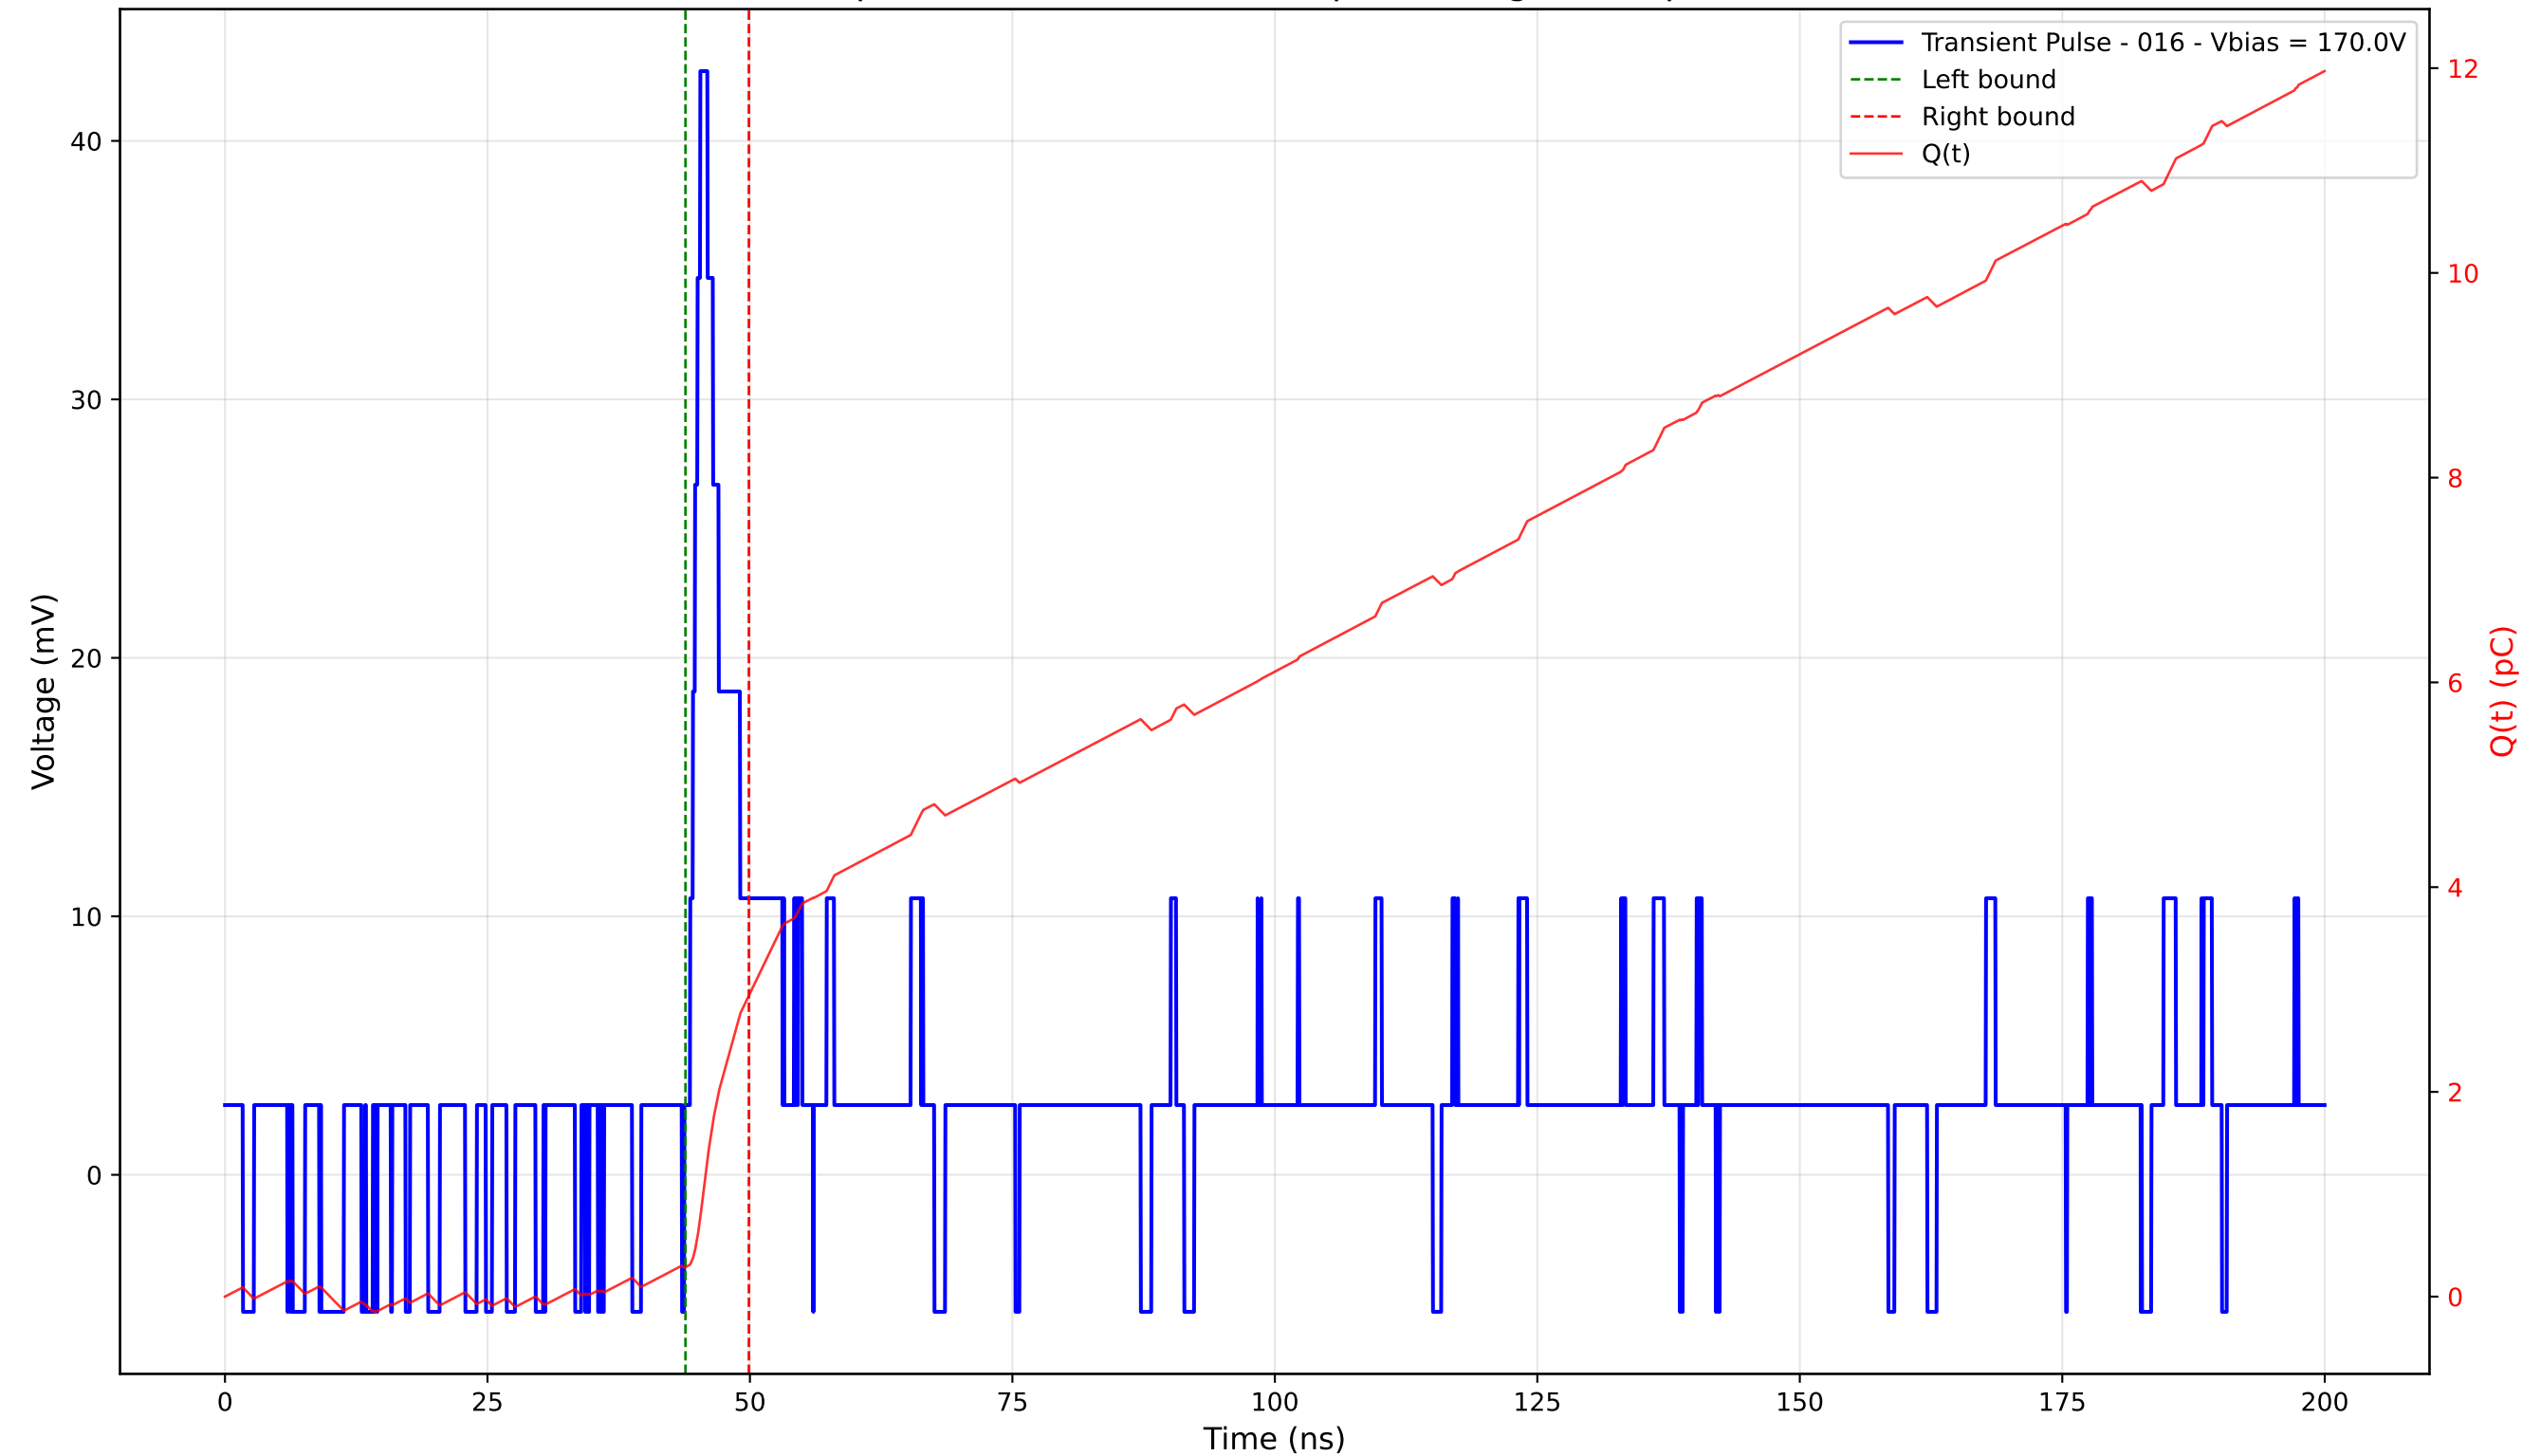


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 4.65 pC - Rise Time: 8.23 ns

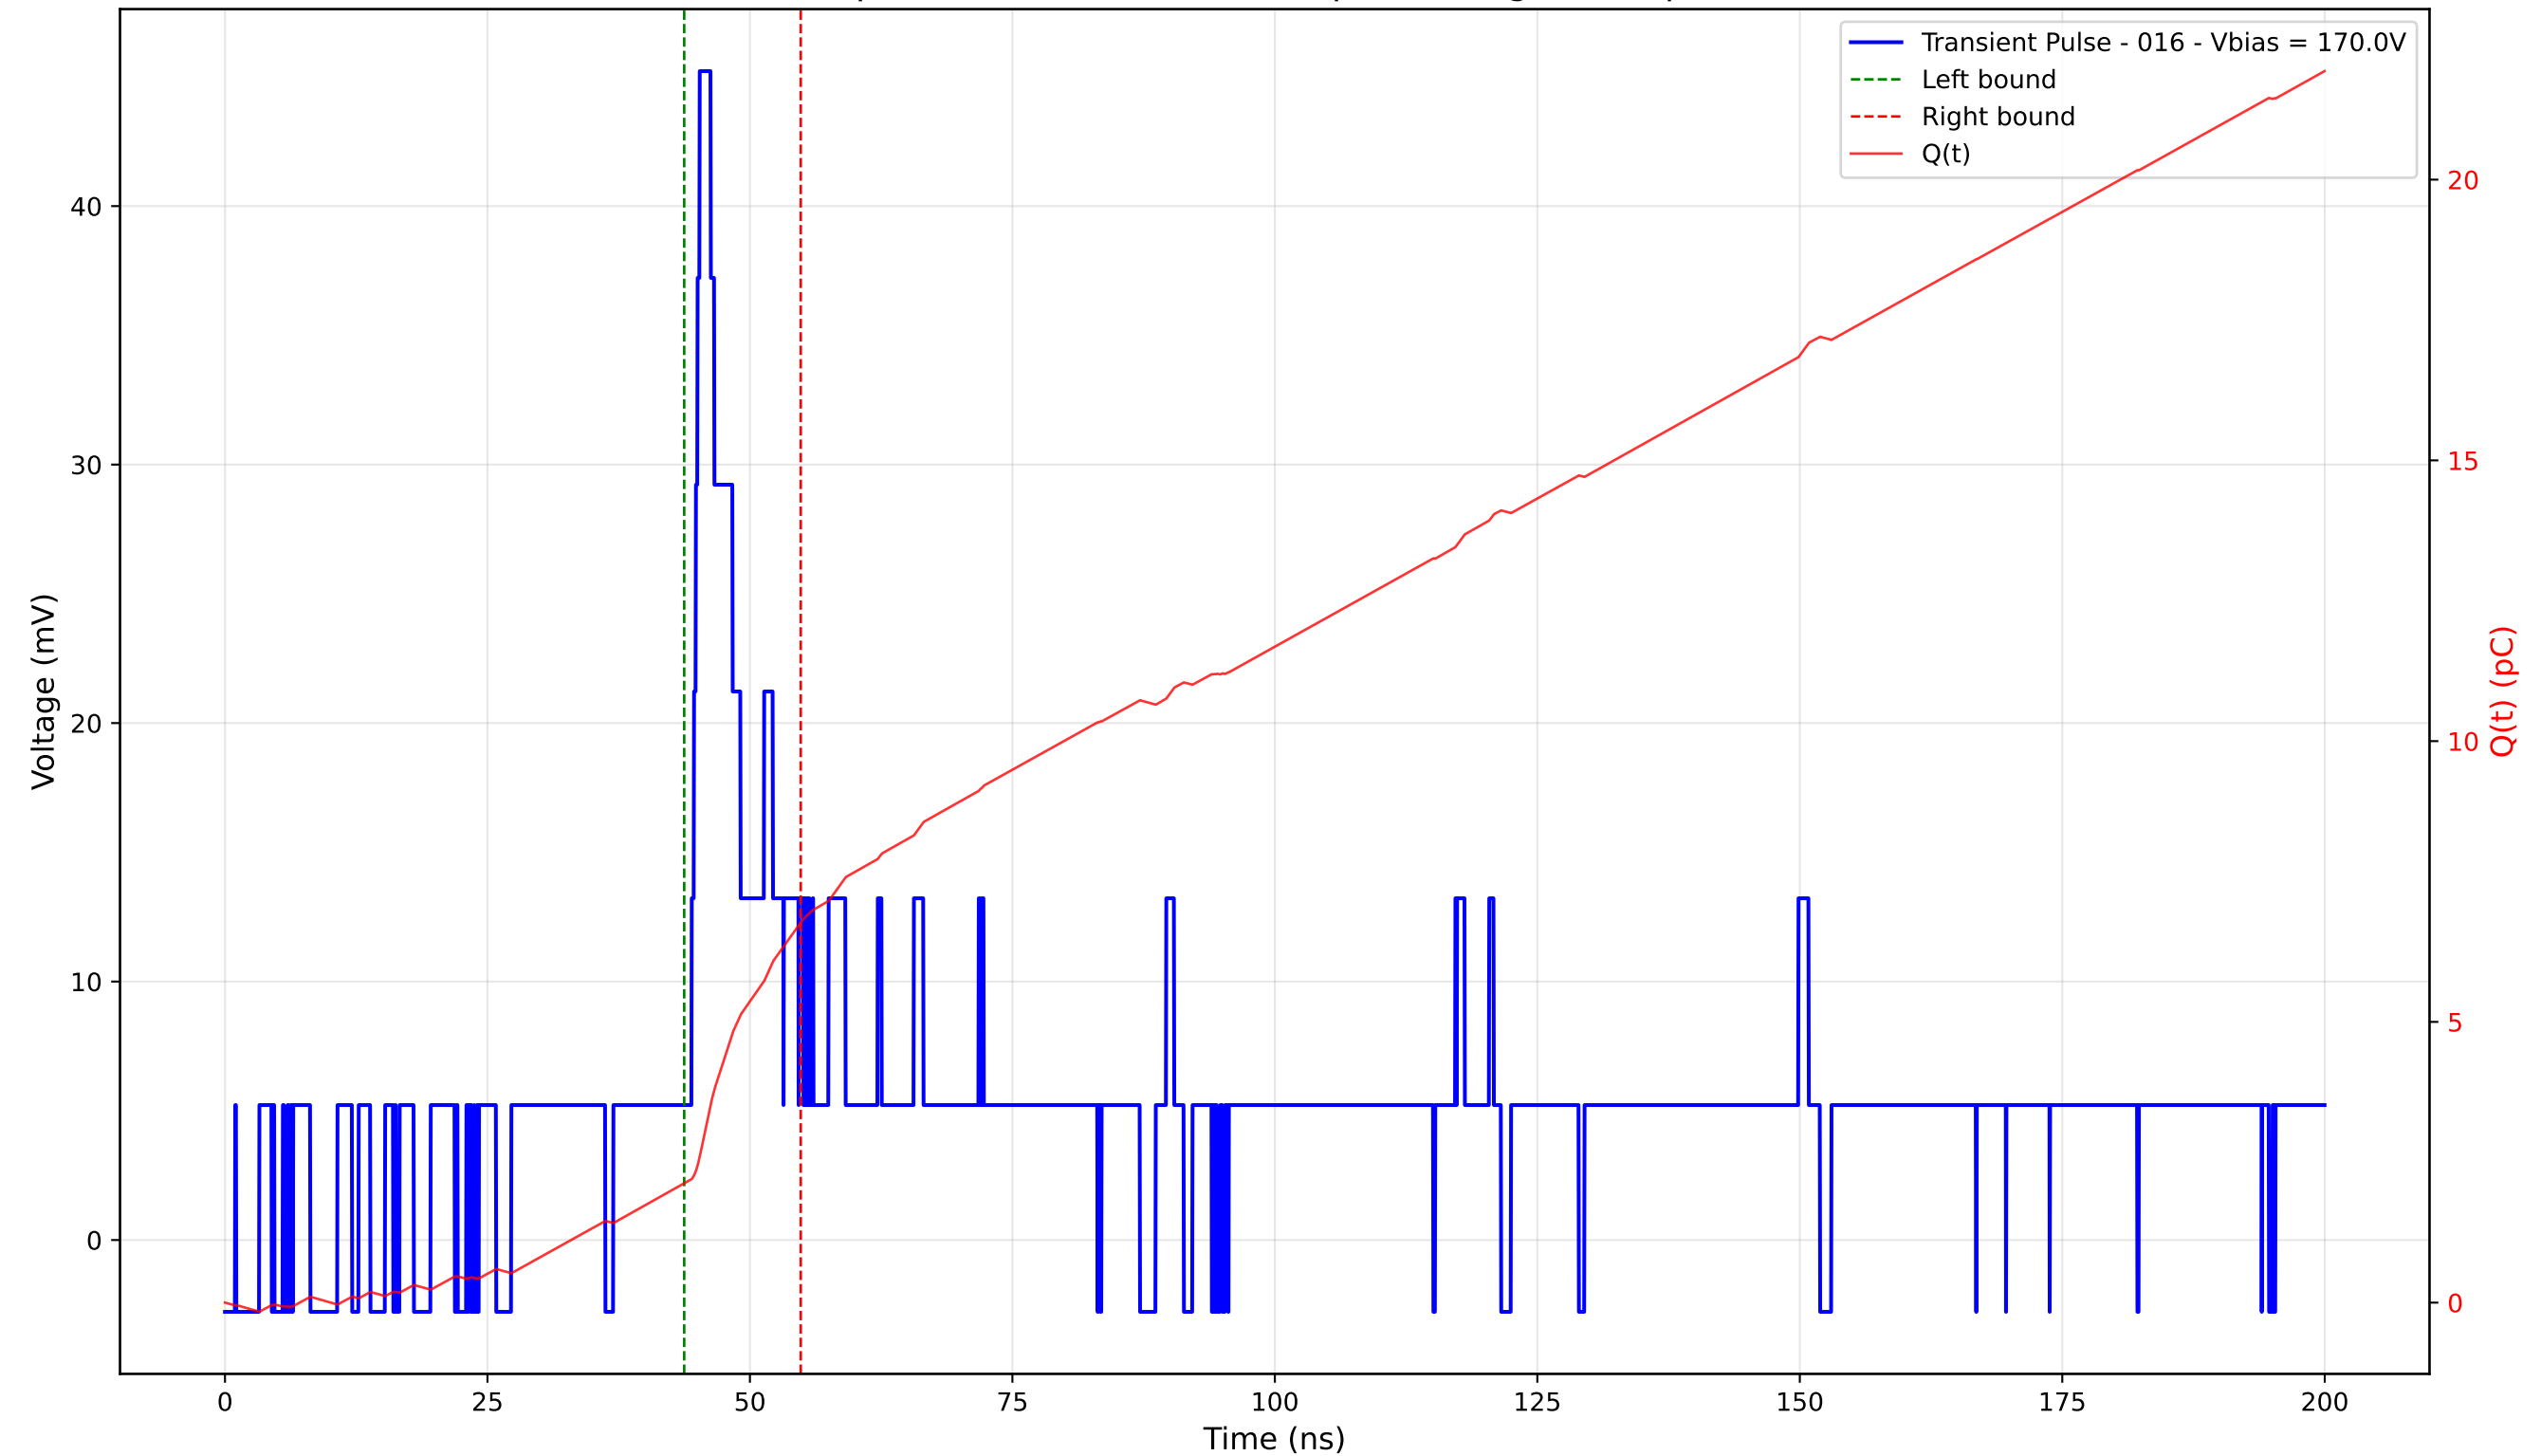


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 4.77 pC - Rise Time: 1.09 ns

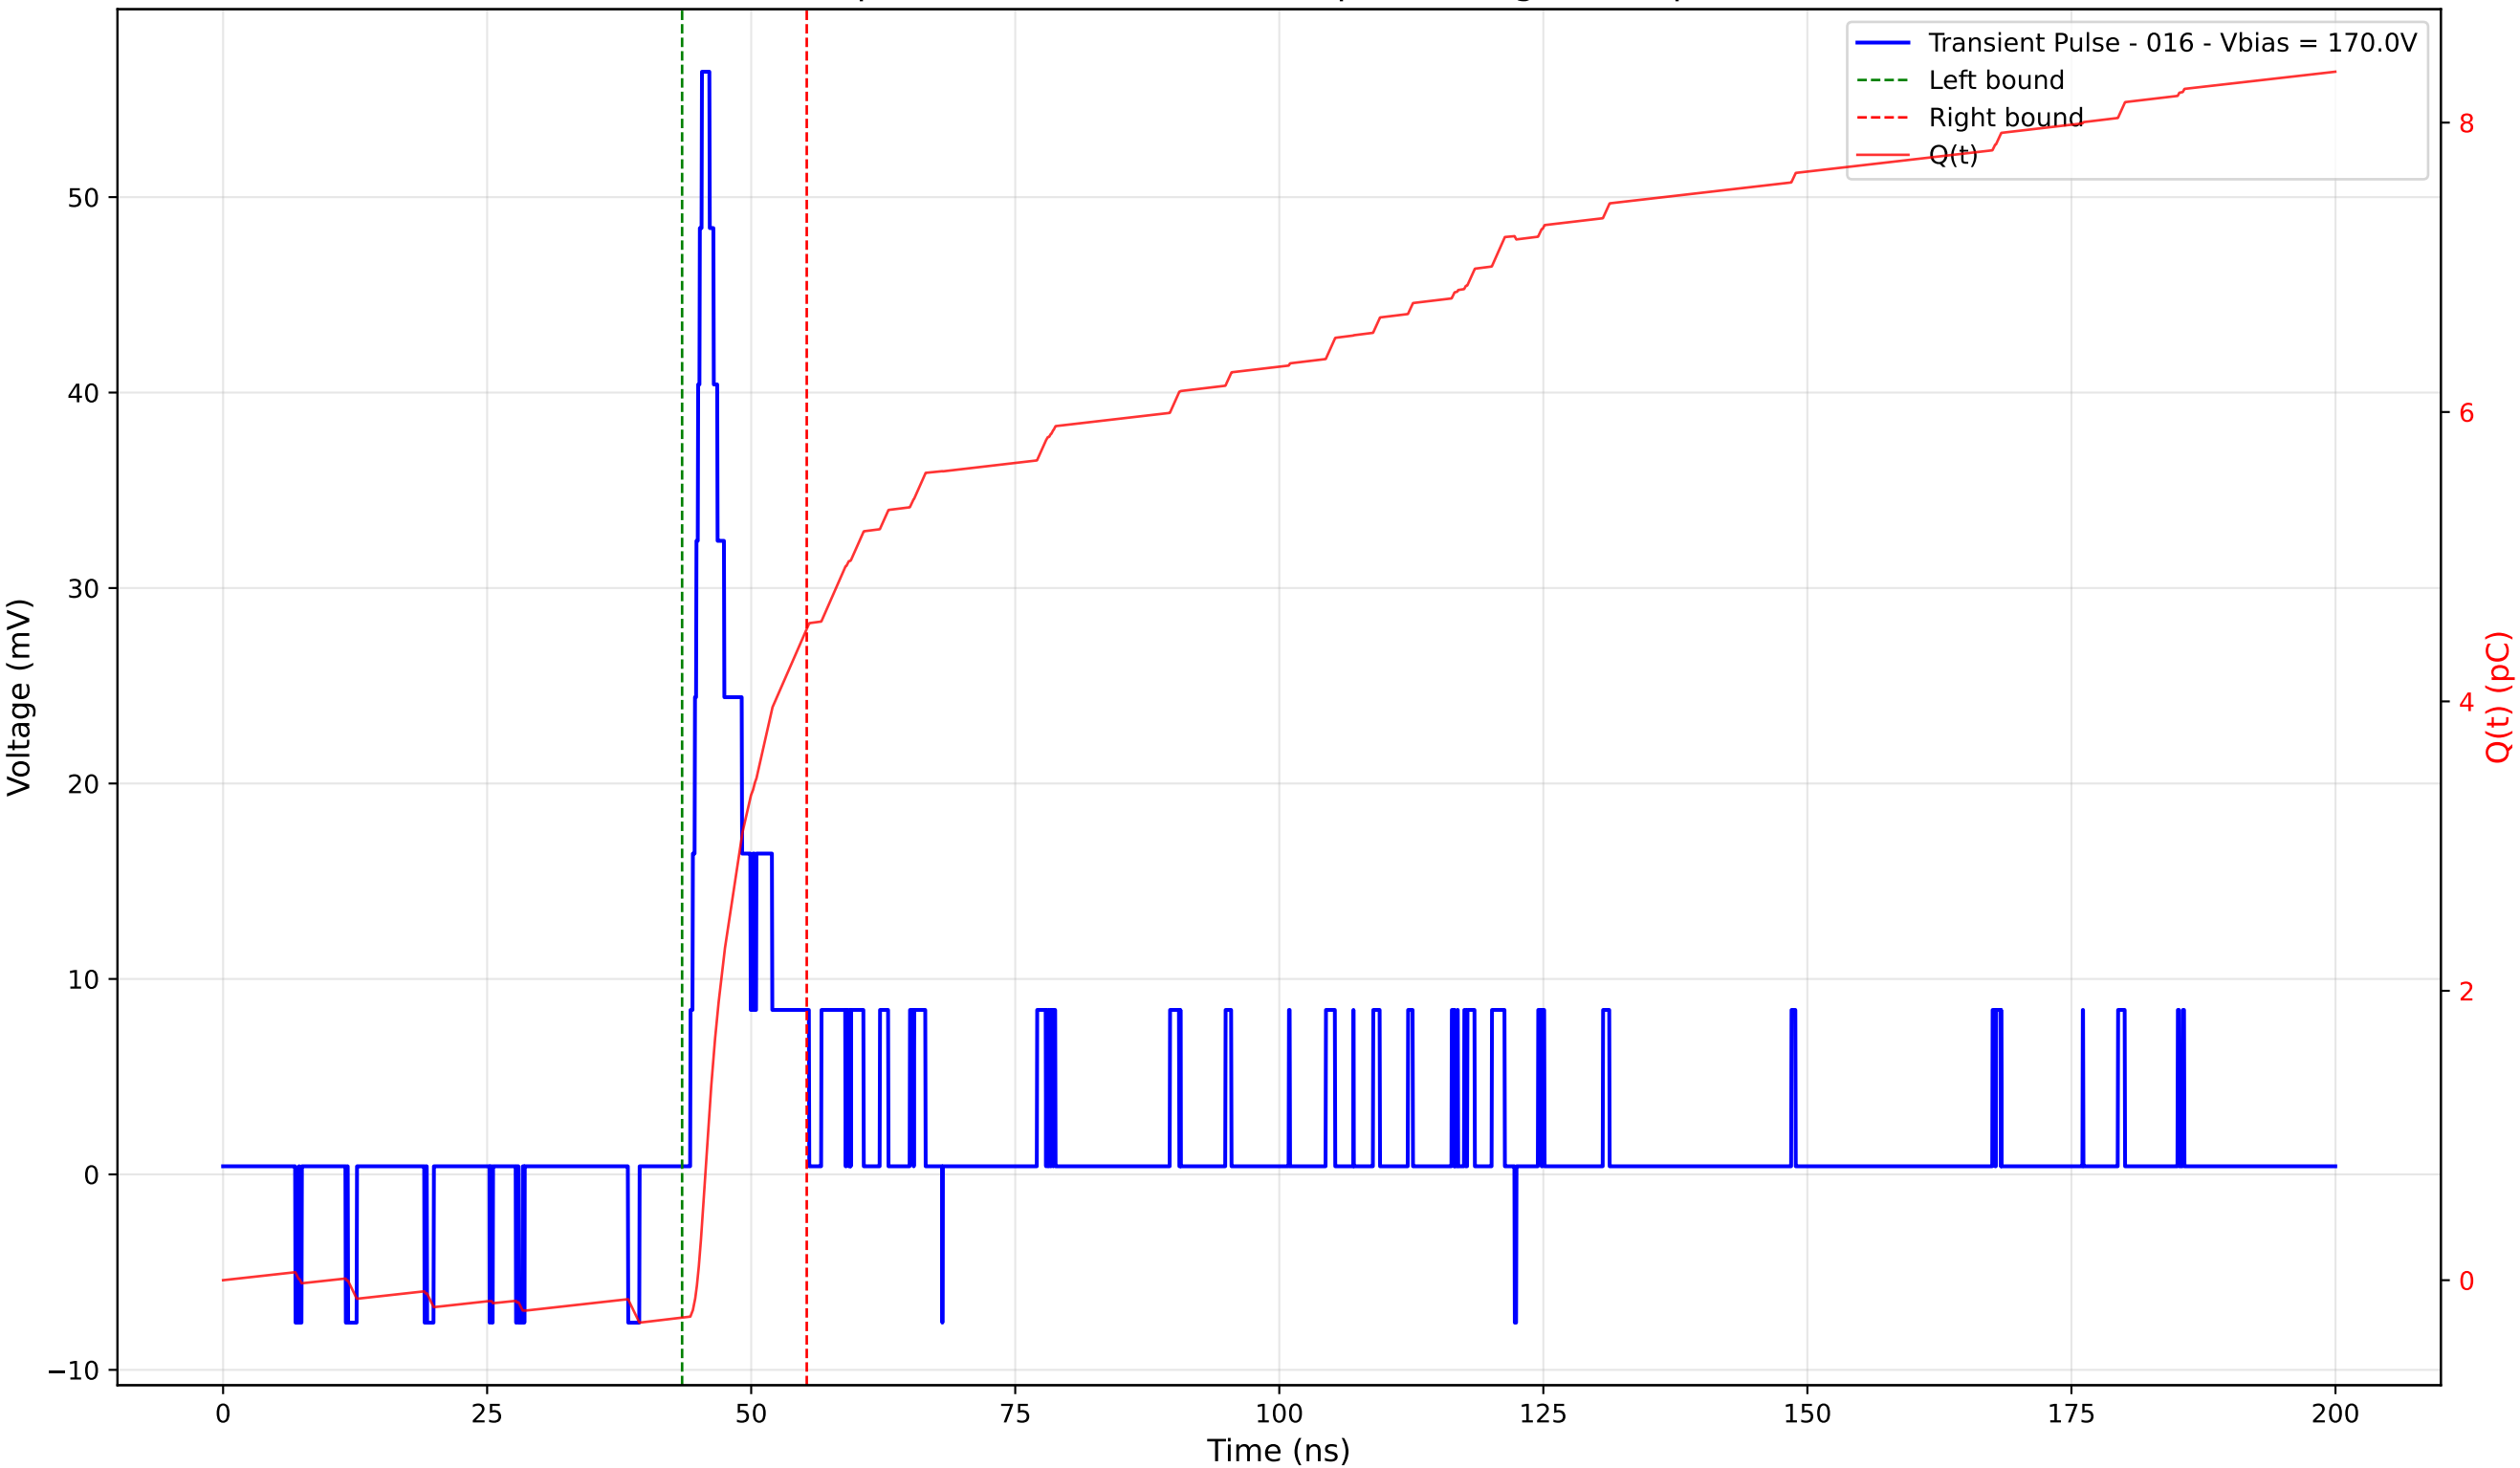


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 4.55 pC - Rise Time: 1.05 ns

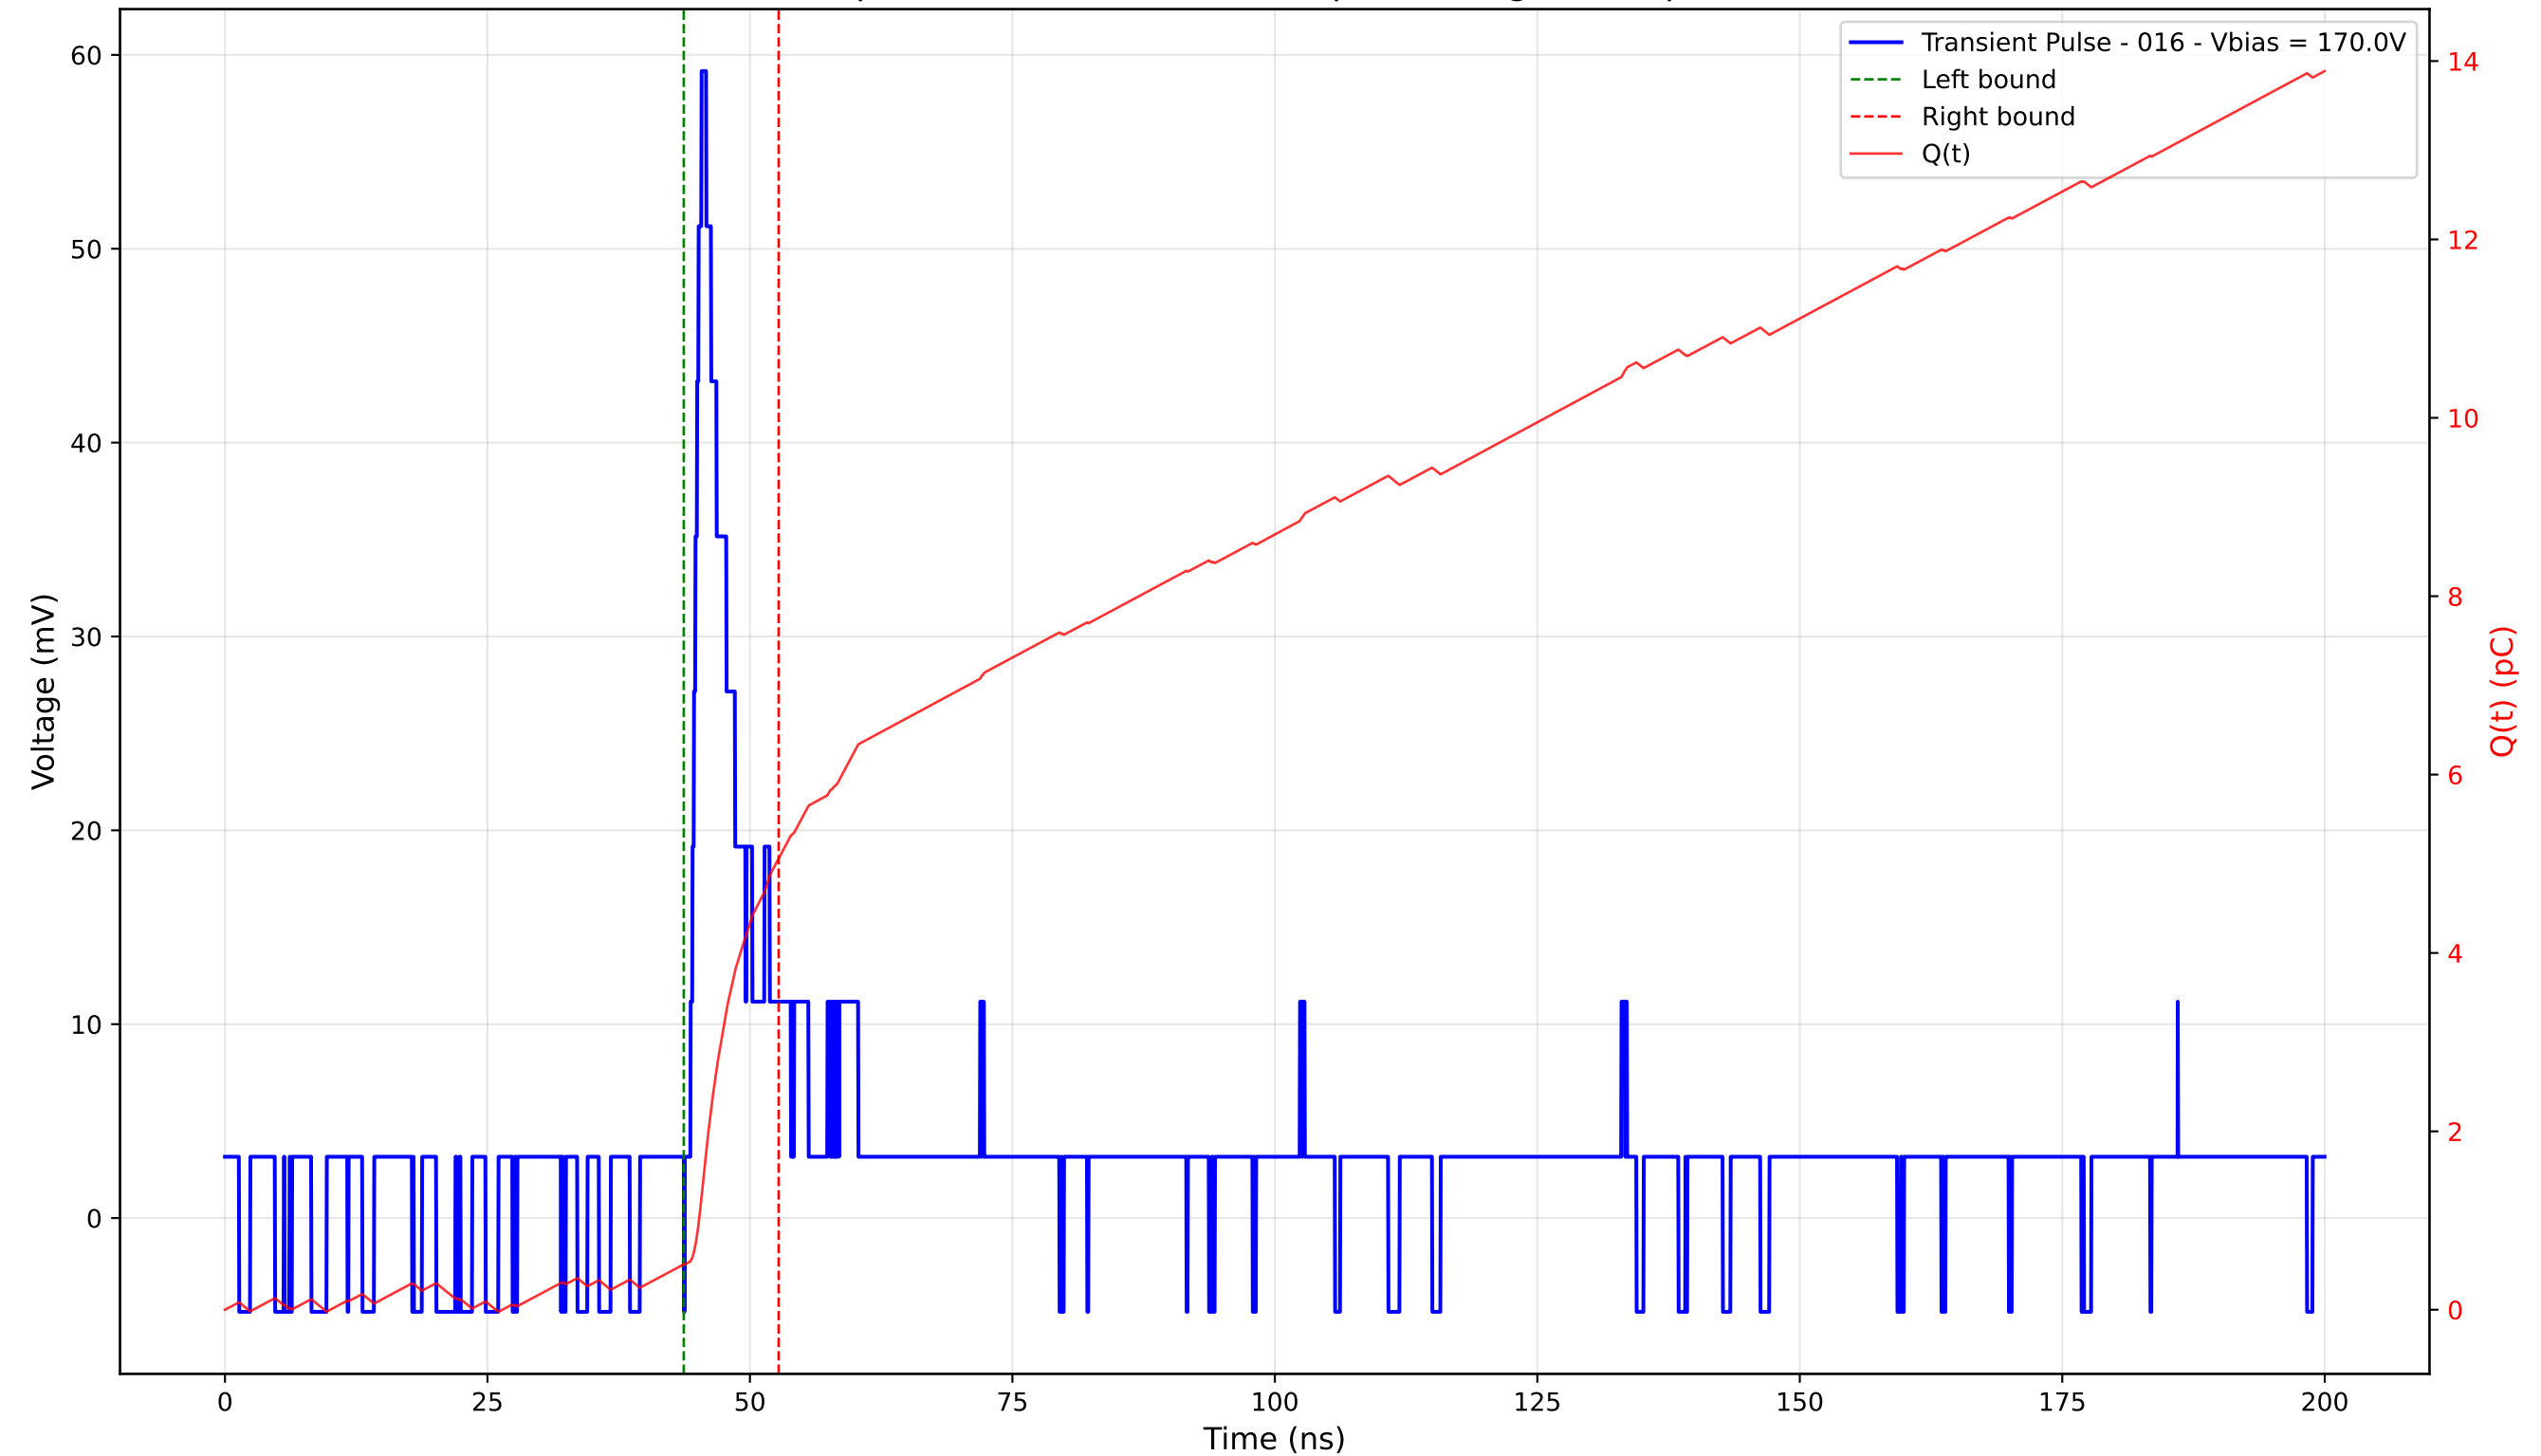


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 5.24 pC - Rise Time: 1.26 ns

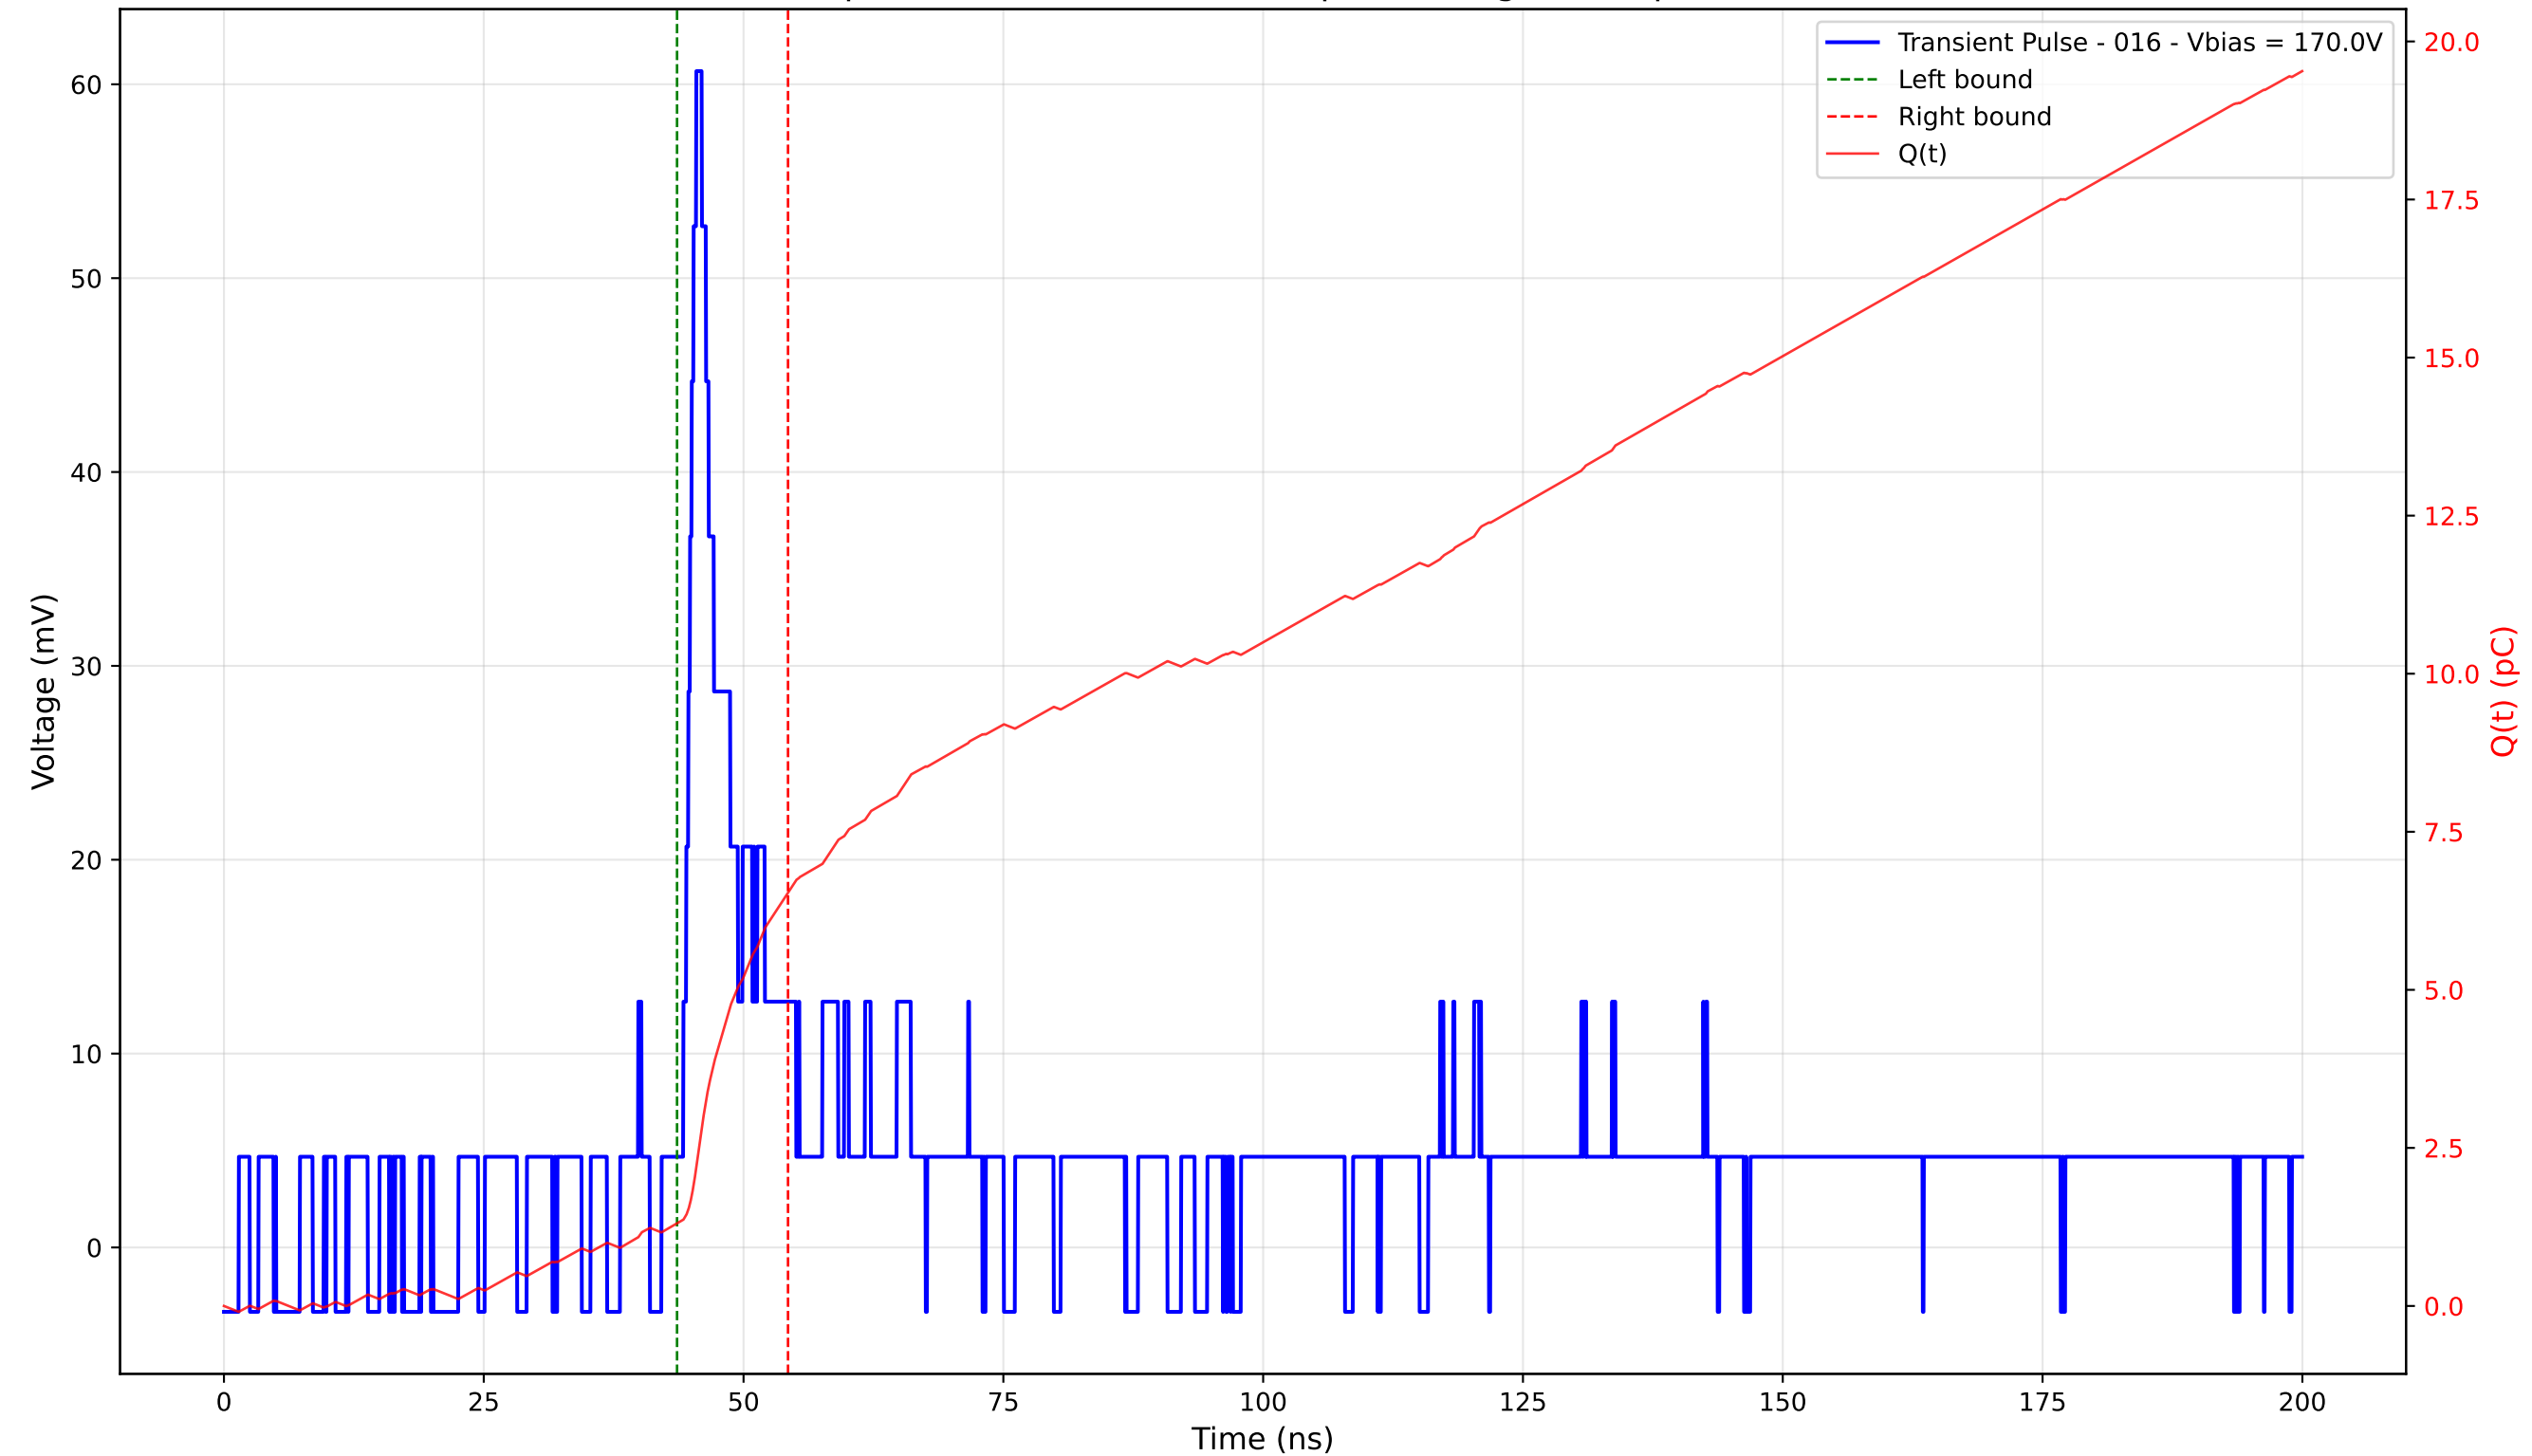


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 4.07 pC - Rise Time: 0.99 ns

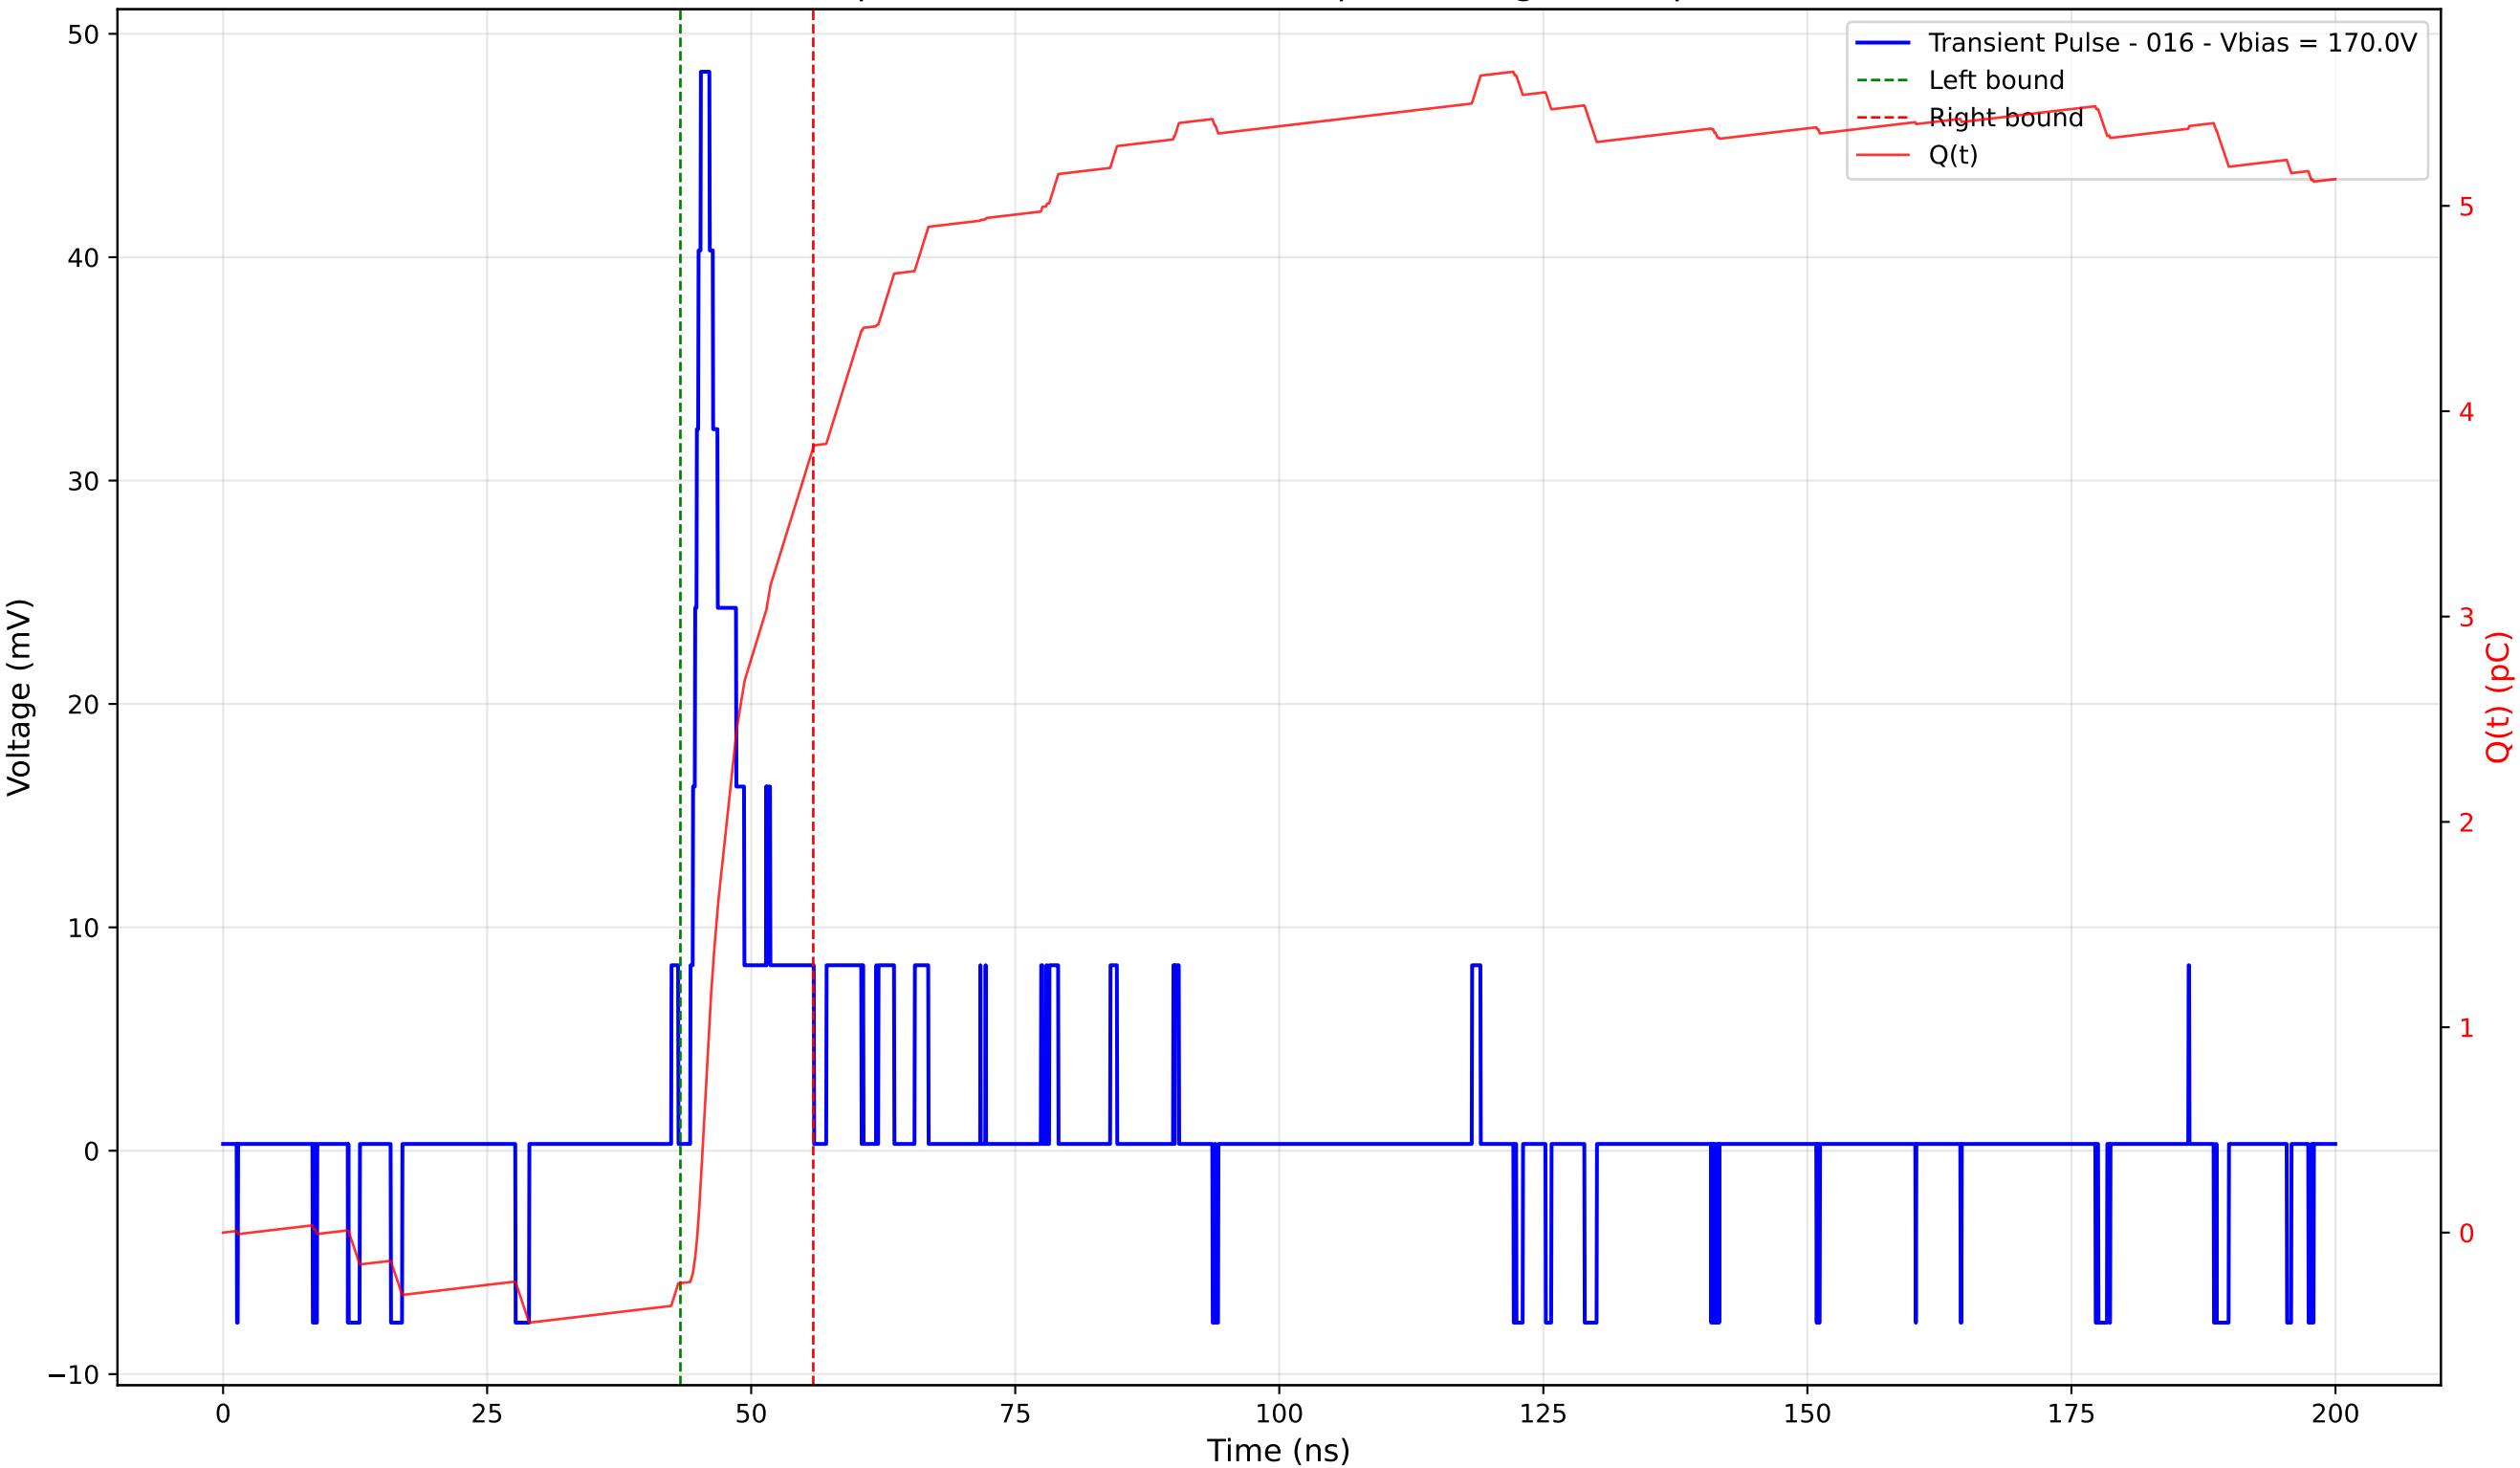


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 2.52 pC - Rise Time: 0.83 ns

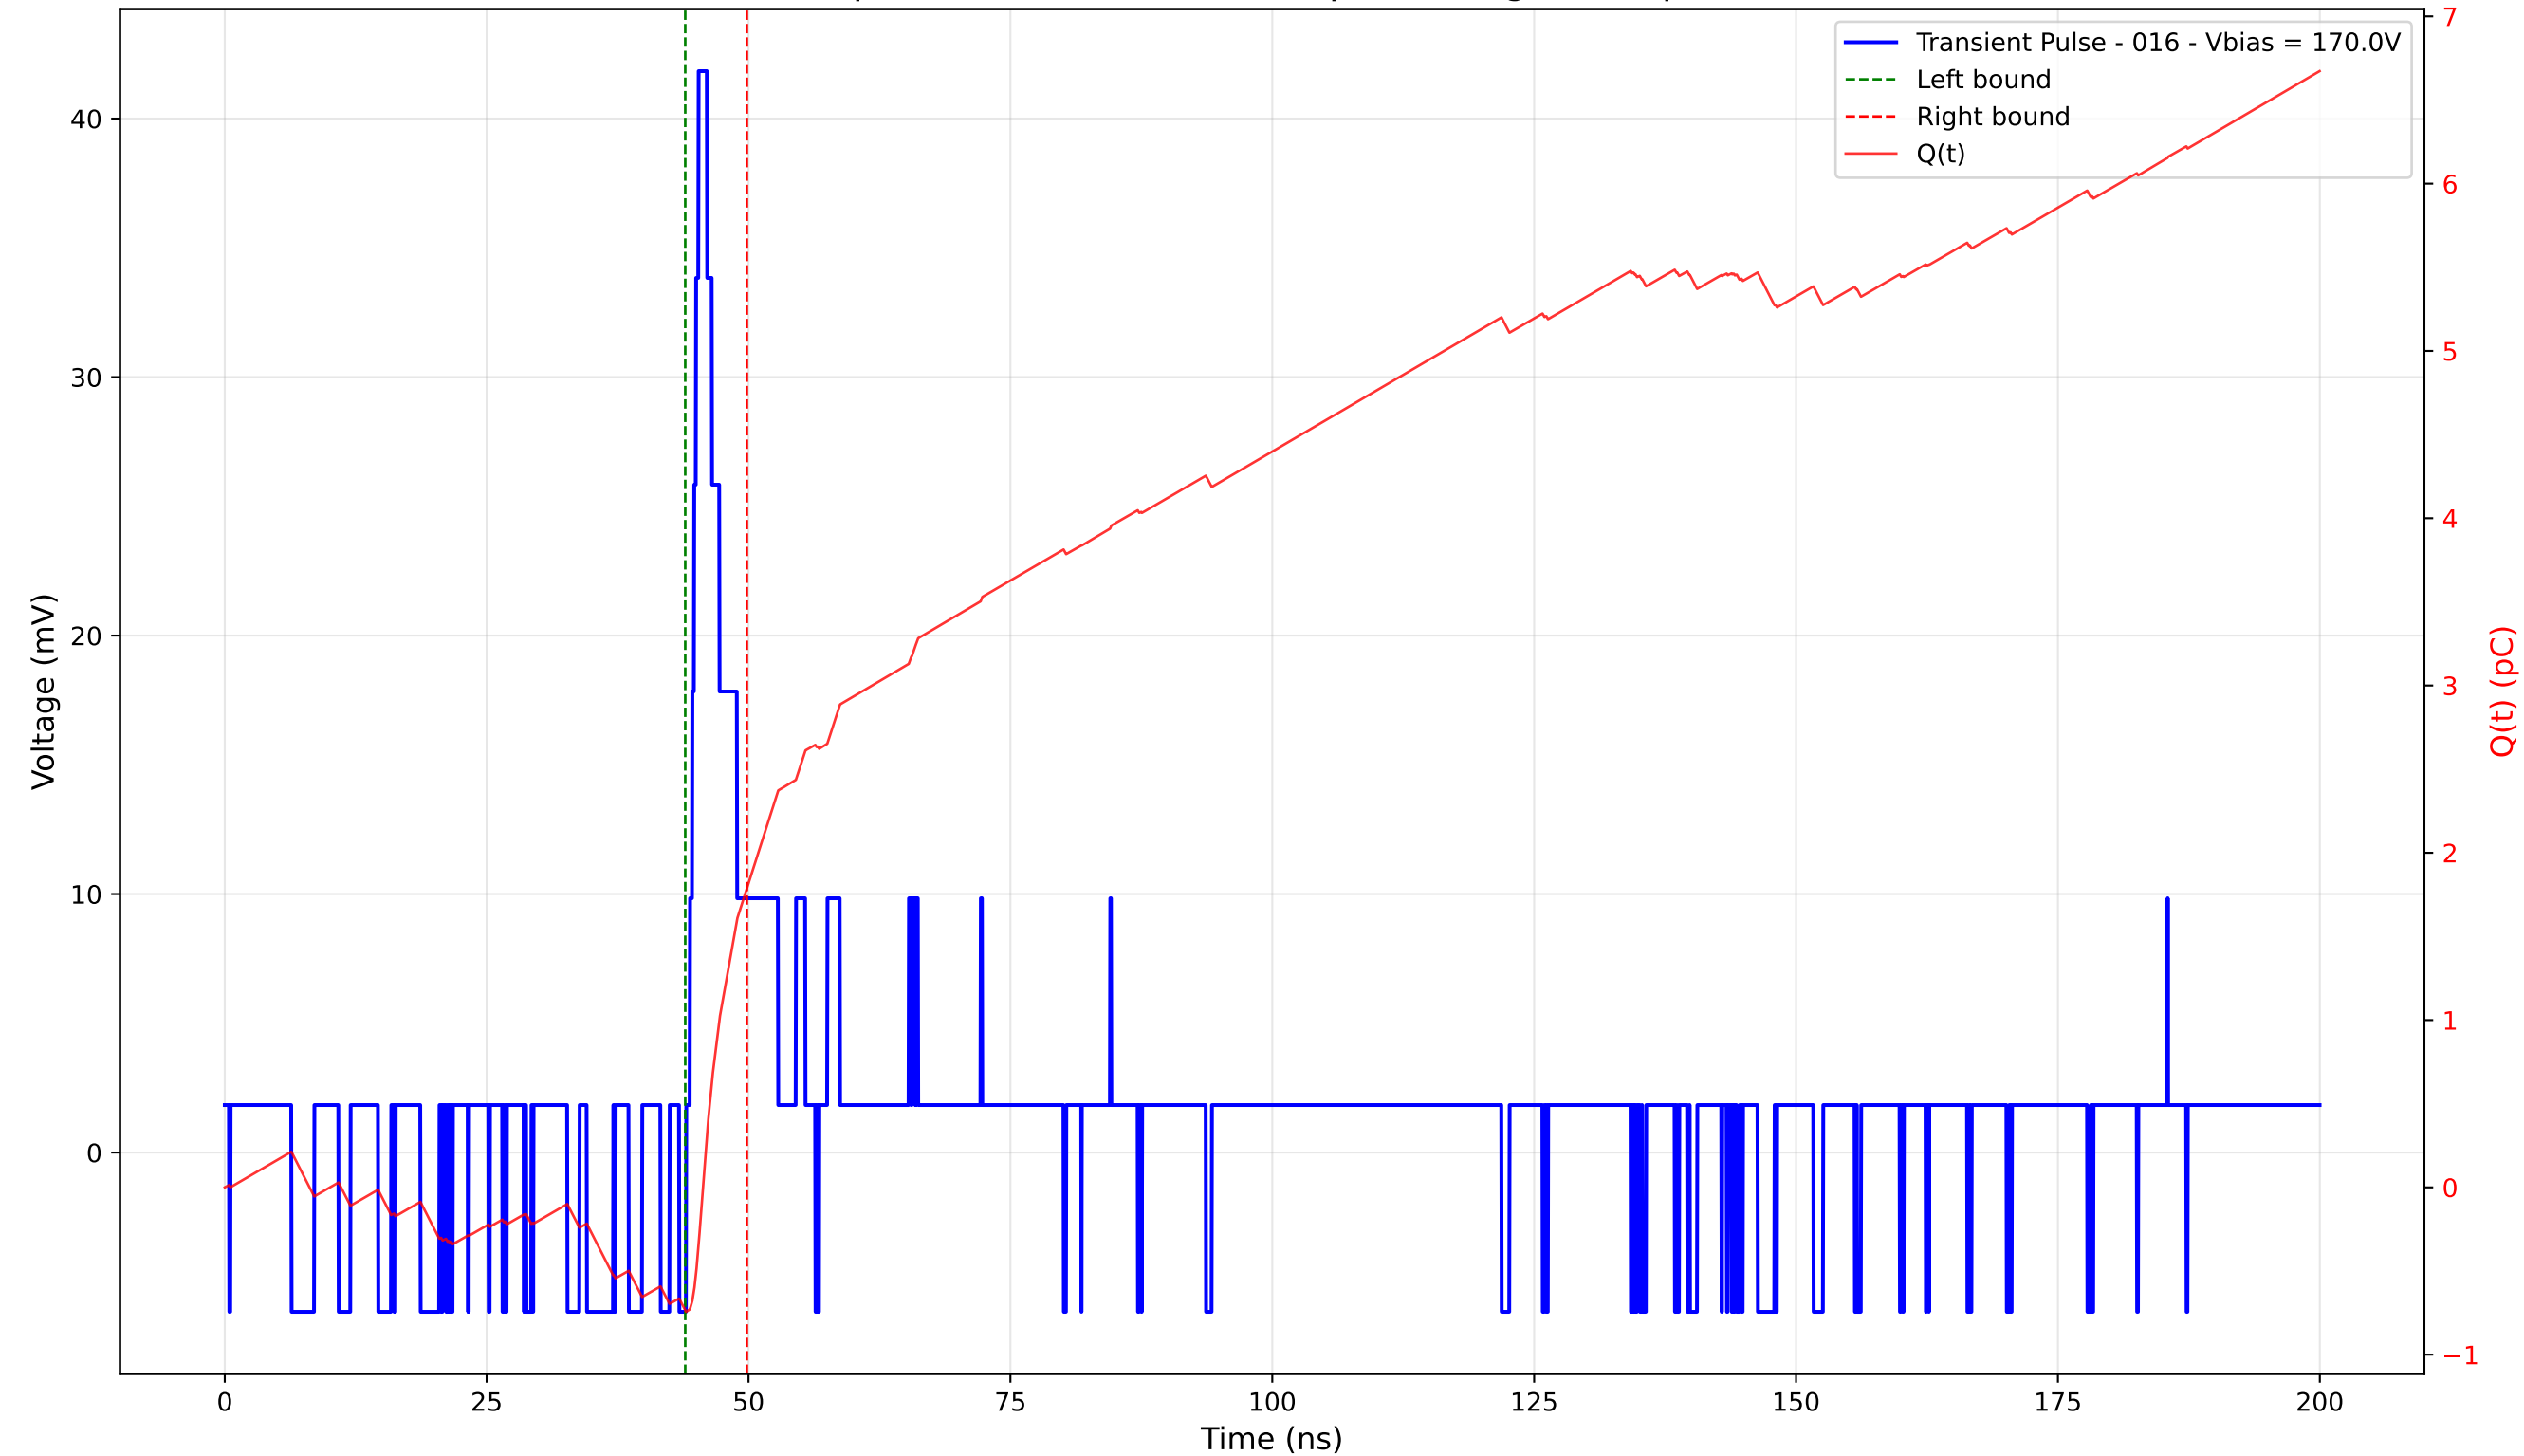


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 1.85 pC - Rise Time: 0.98 ns

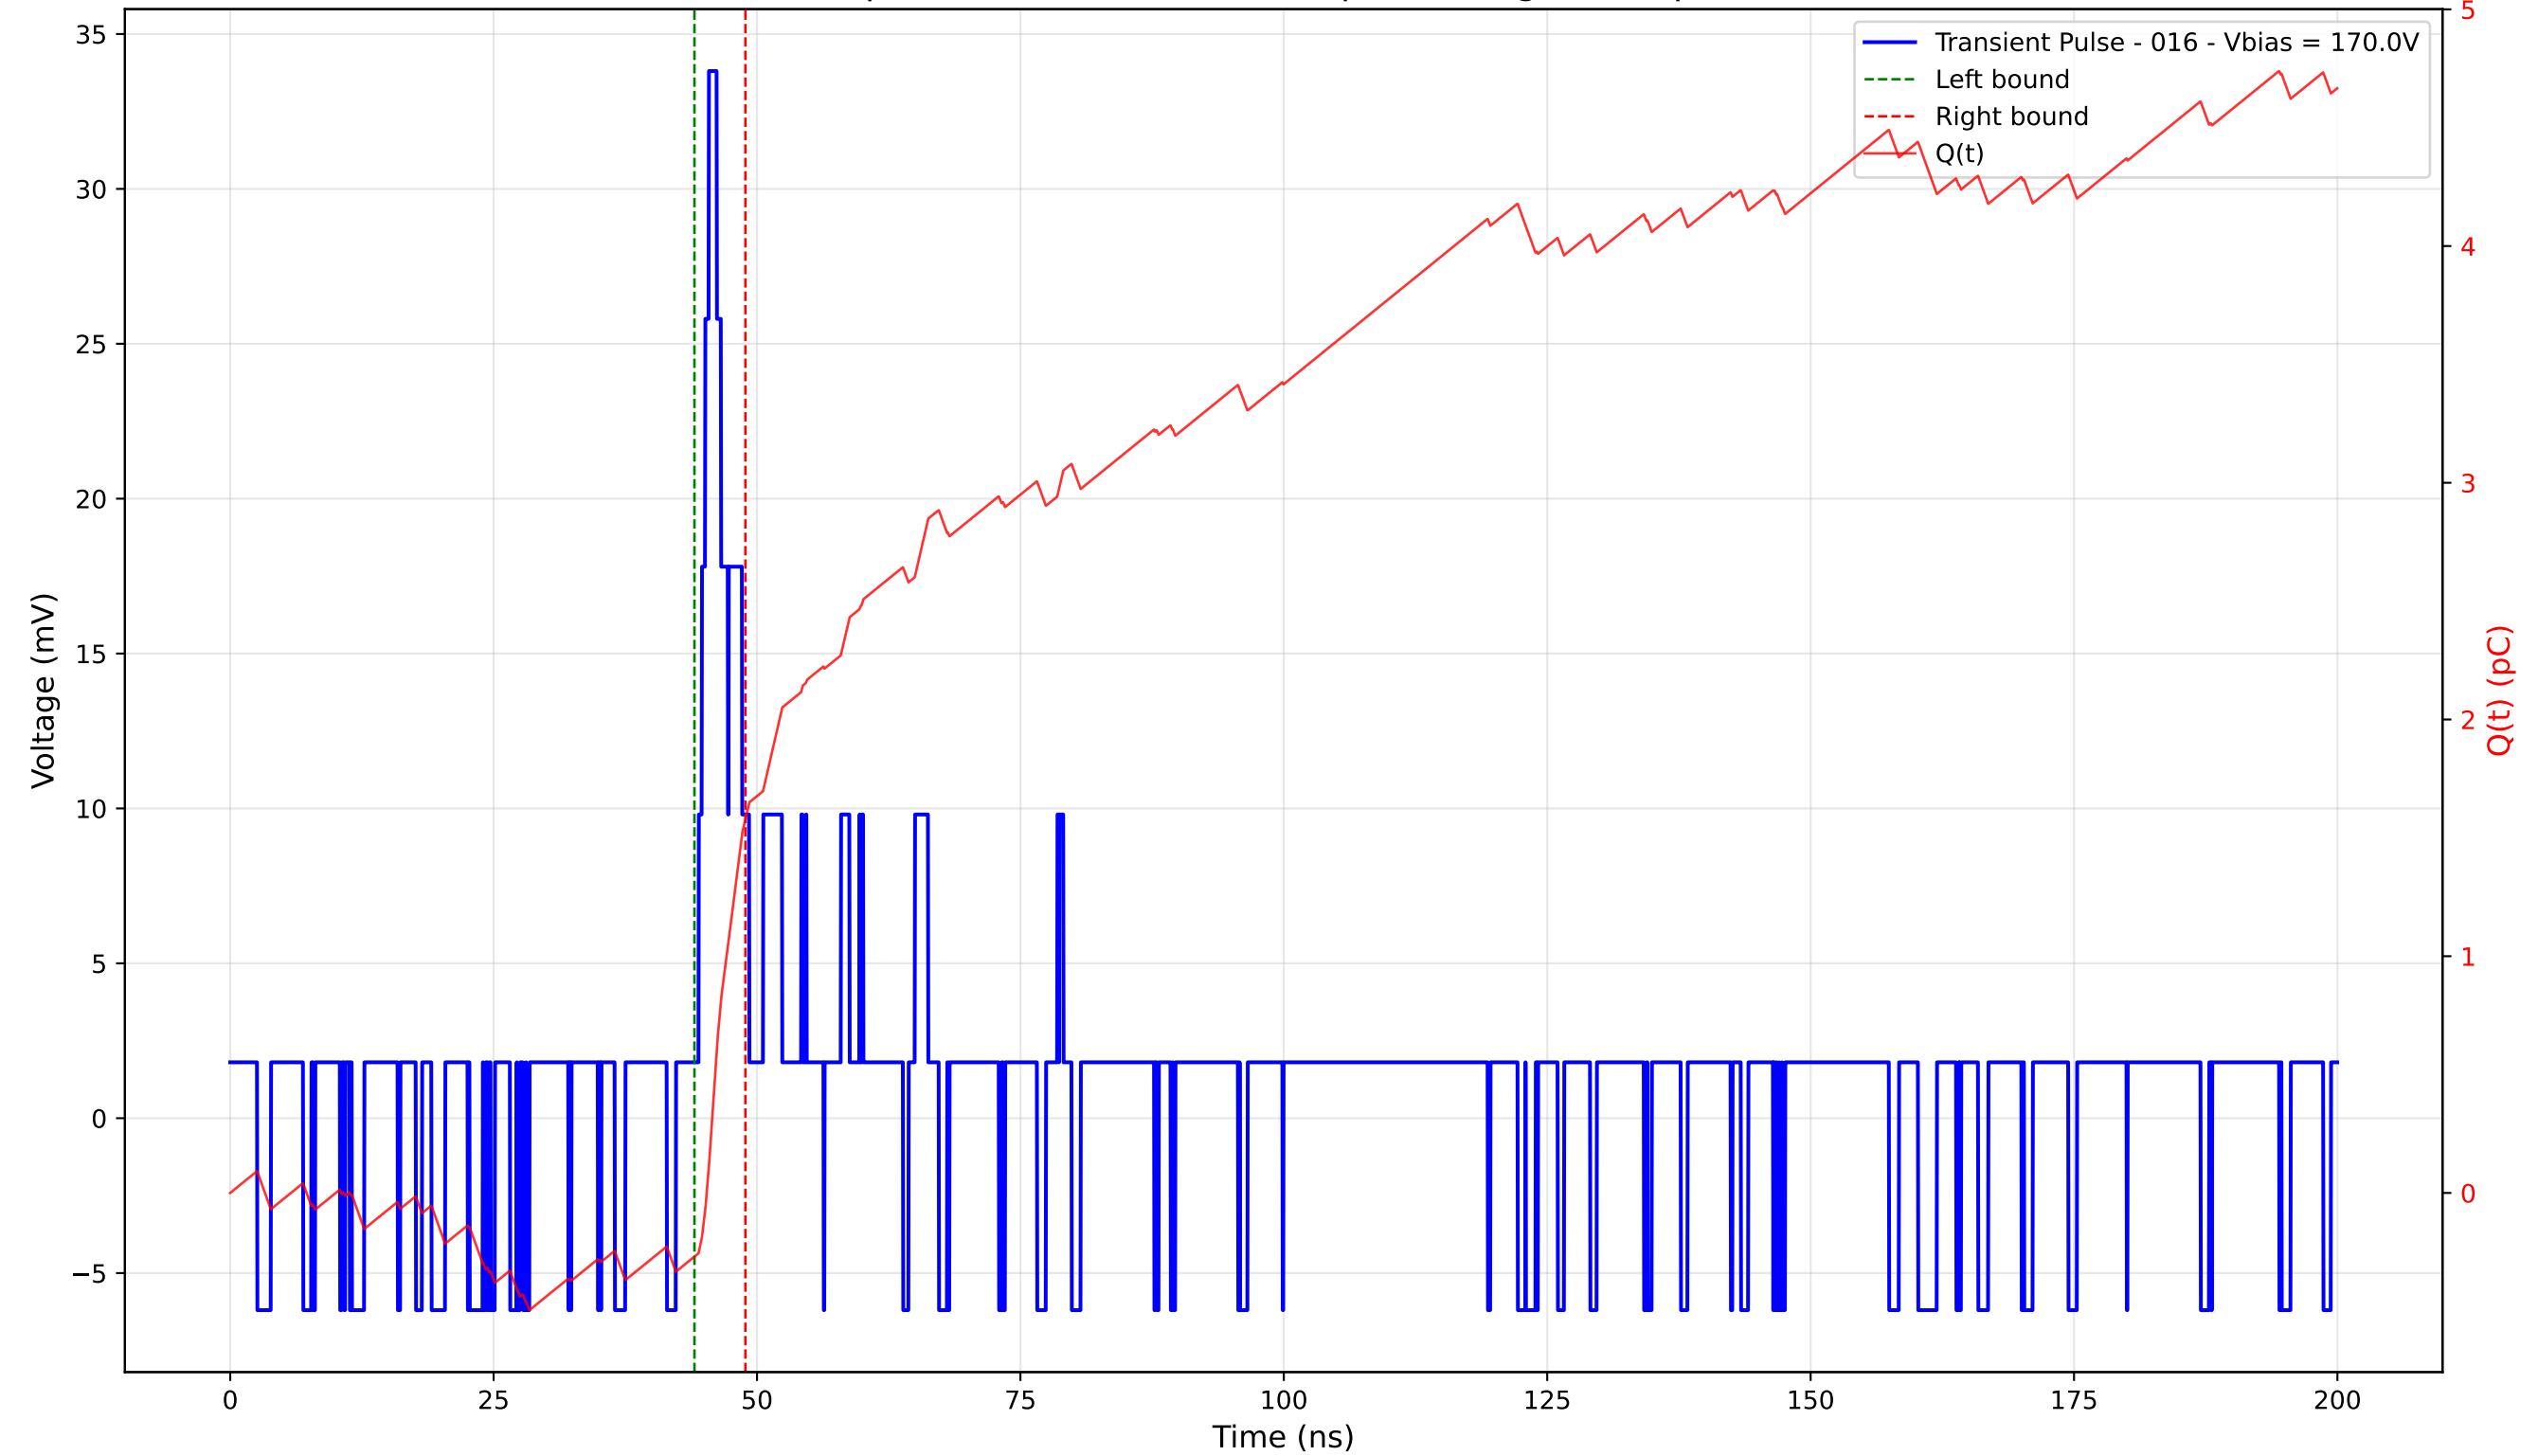

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.45 pC - Rise Time: 0.85 ns

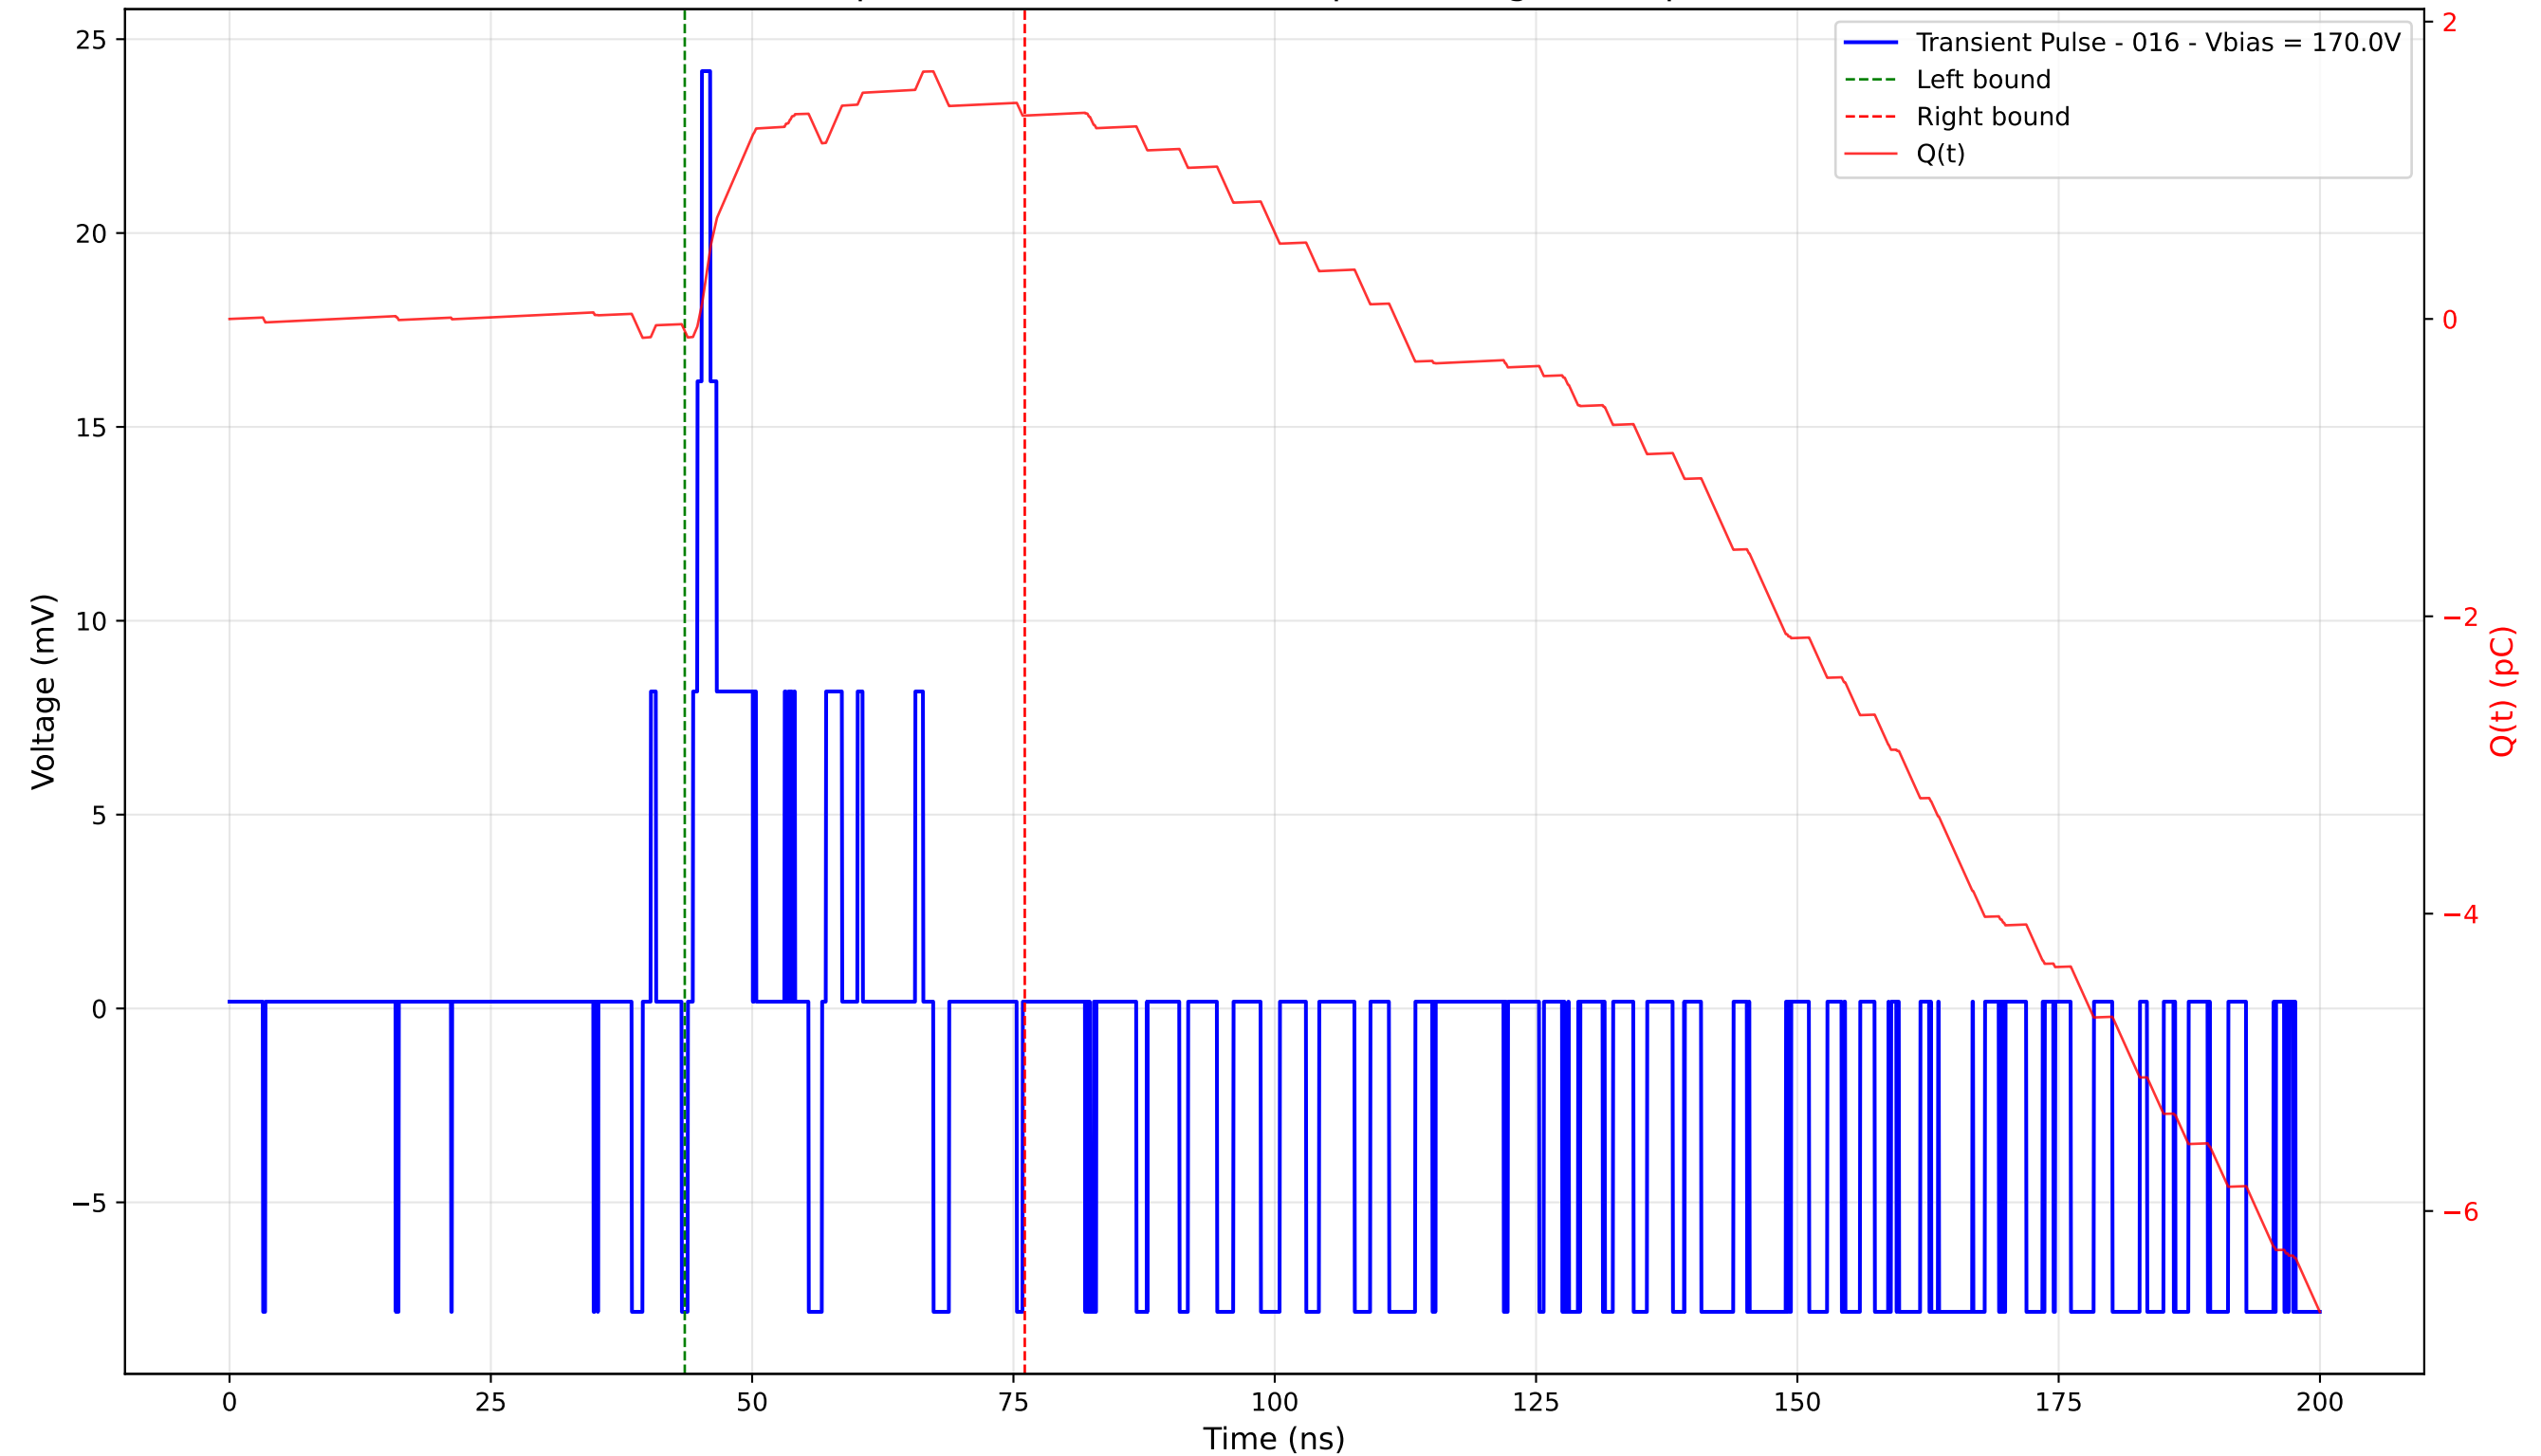

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 2.73 pC - Rise Time: 0.00 ns (N/A)

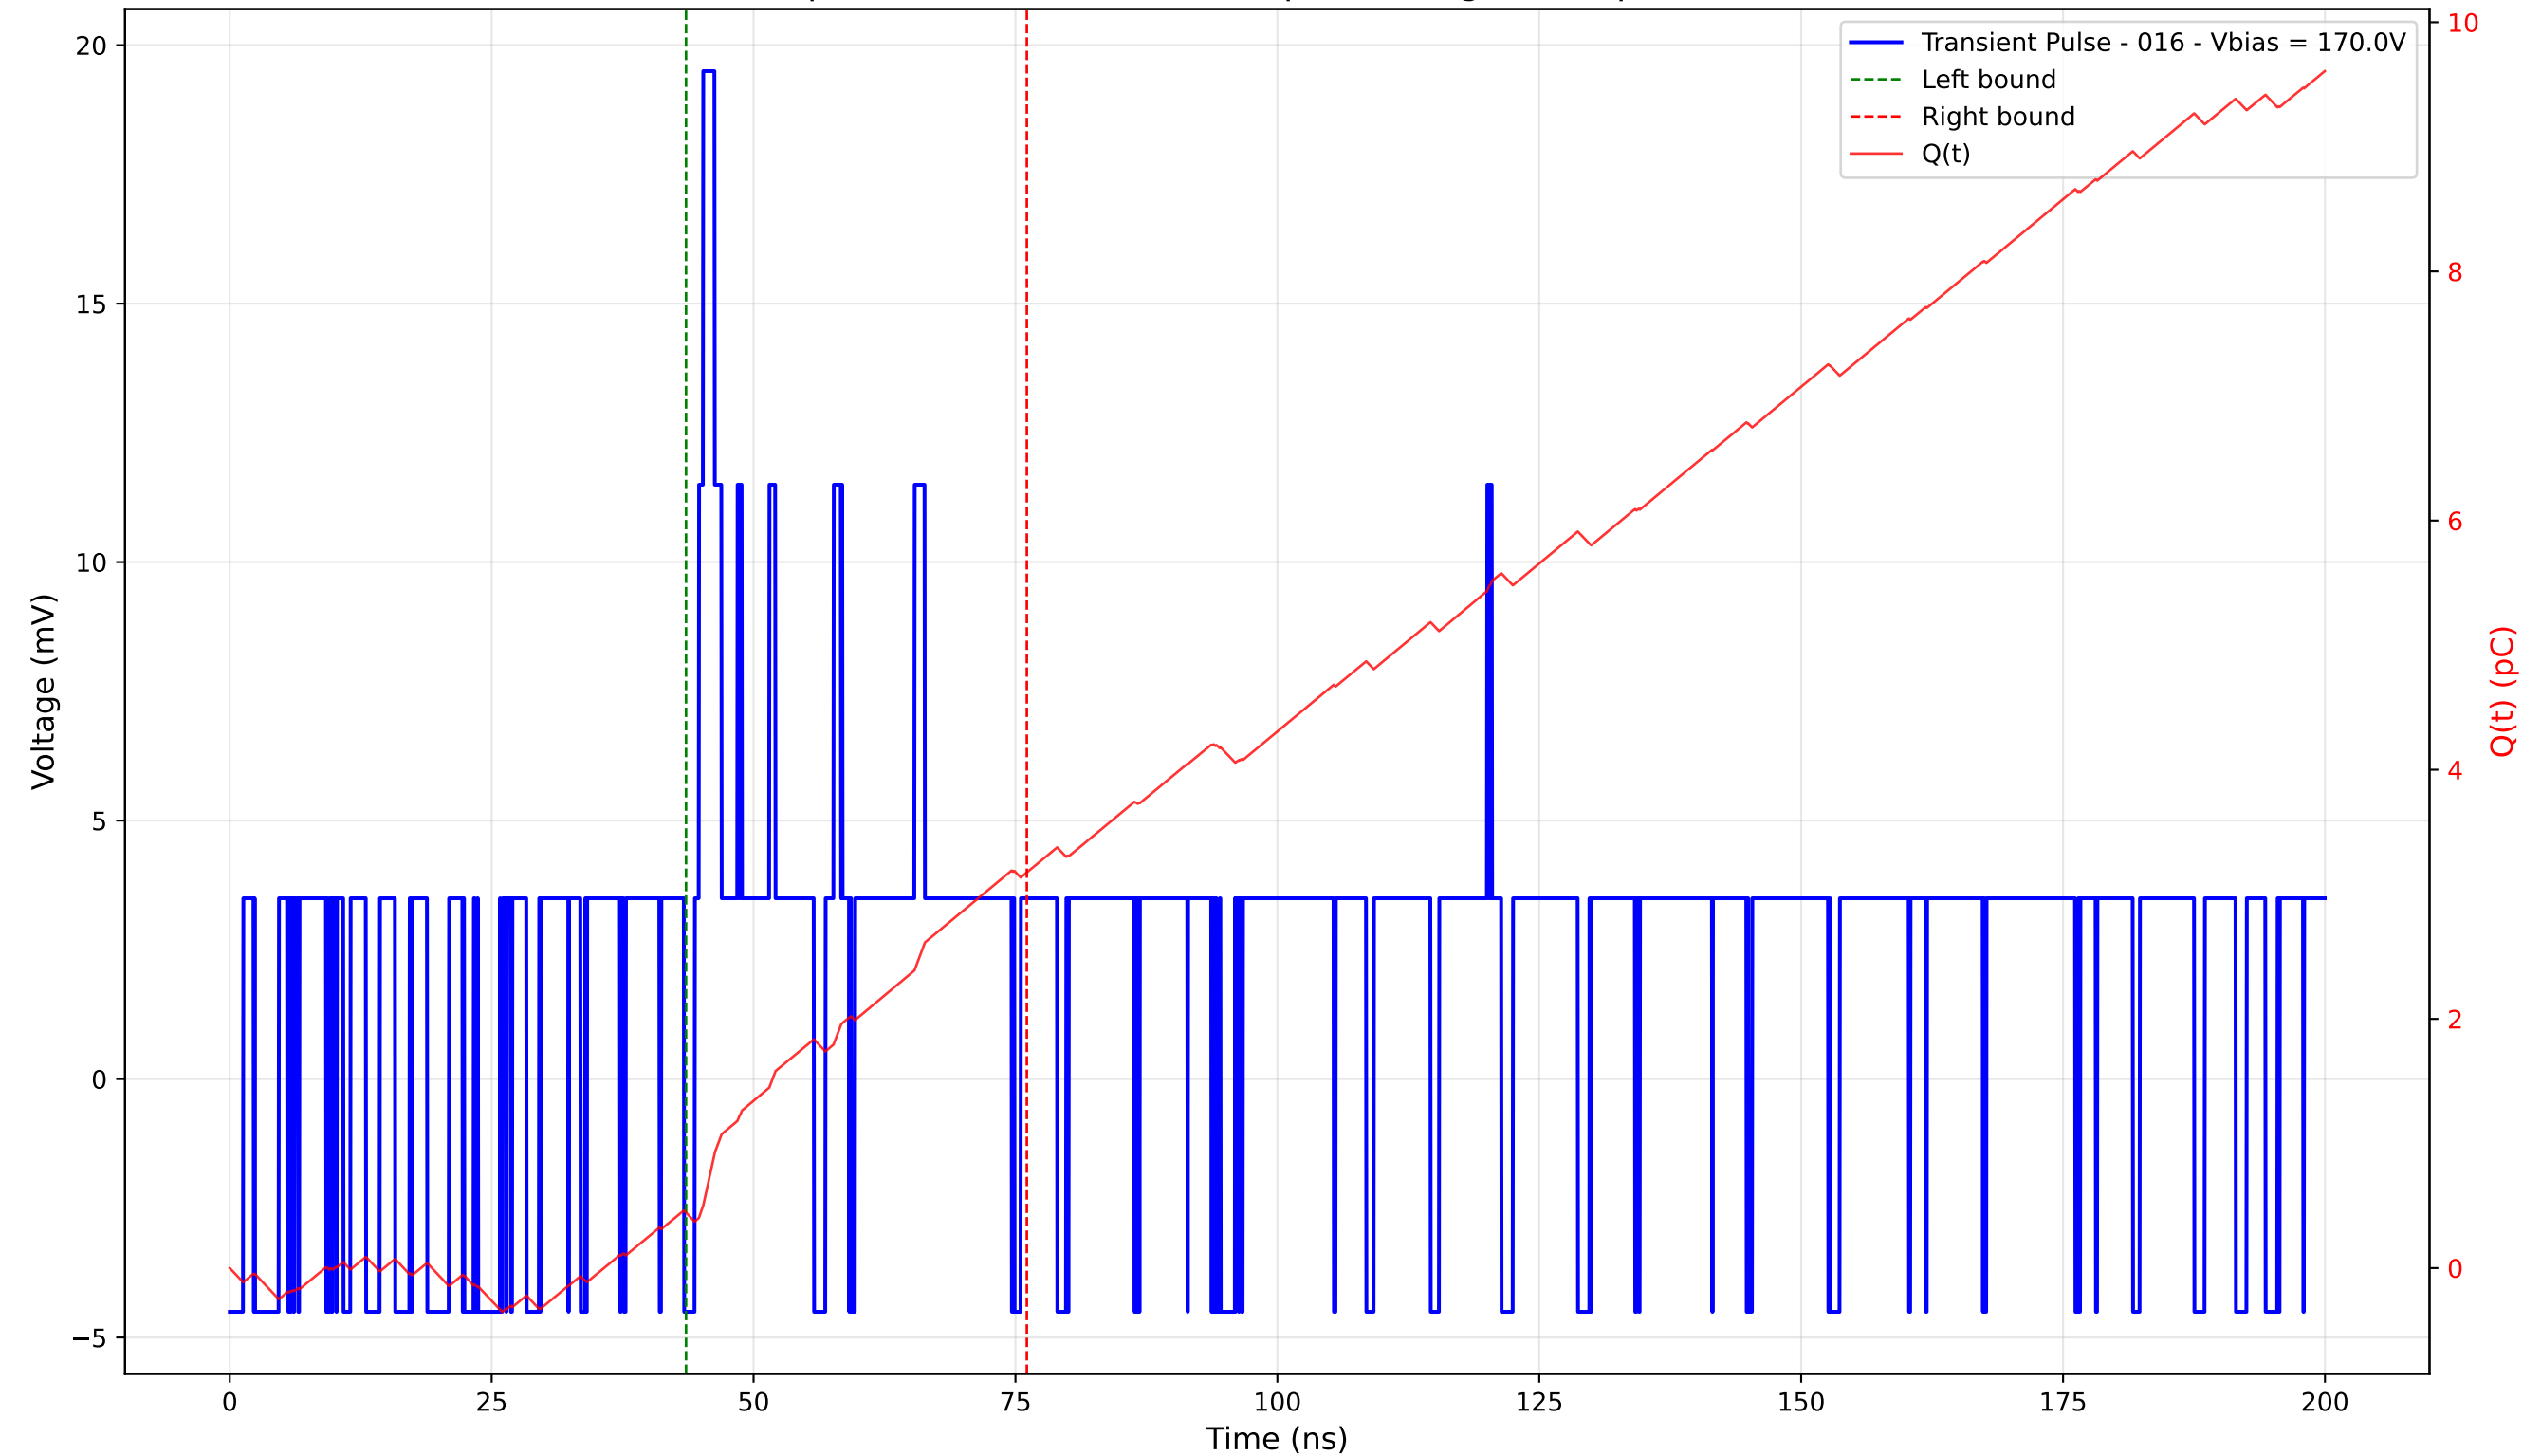

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 2.97 pC - Rise Time: 0.00 ns (N/A)

