


TCT Run 017 Summary

Parameter	Value
Run	Run017
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	150.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\150V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

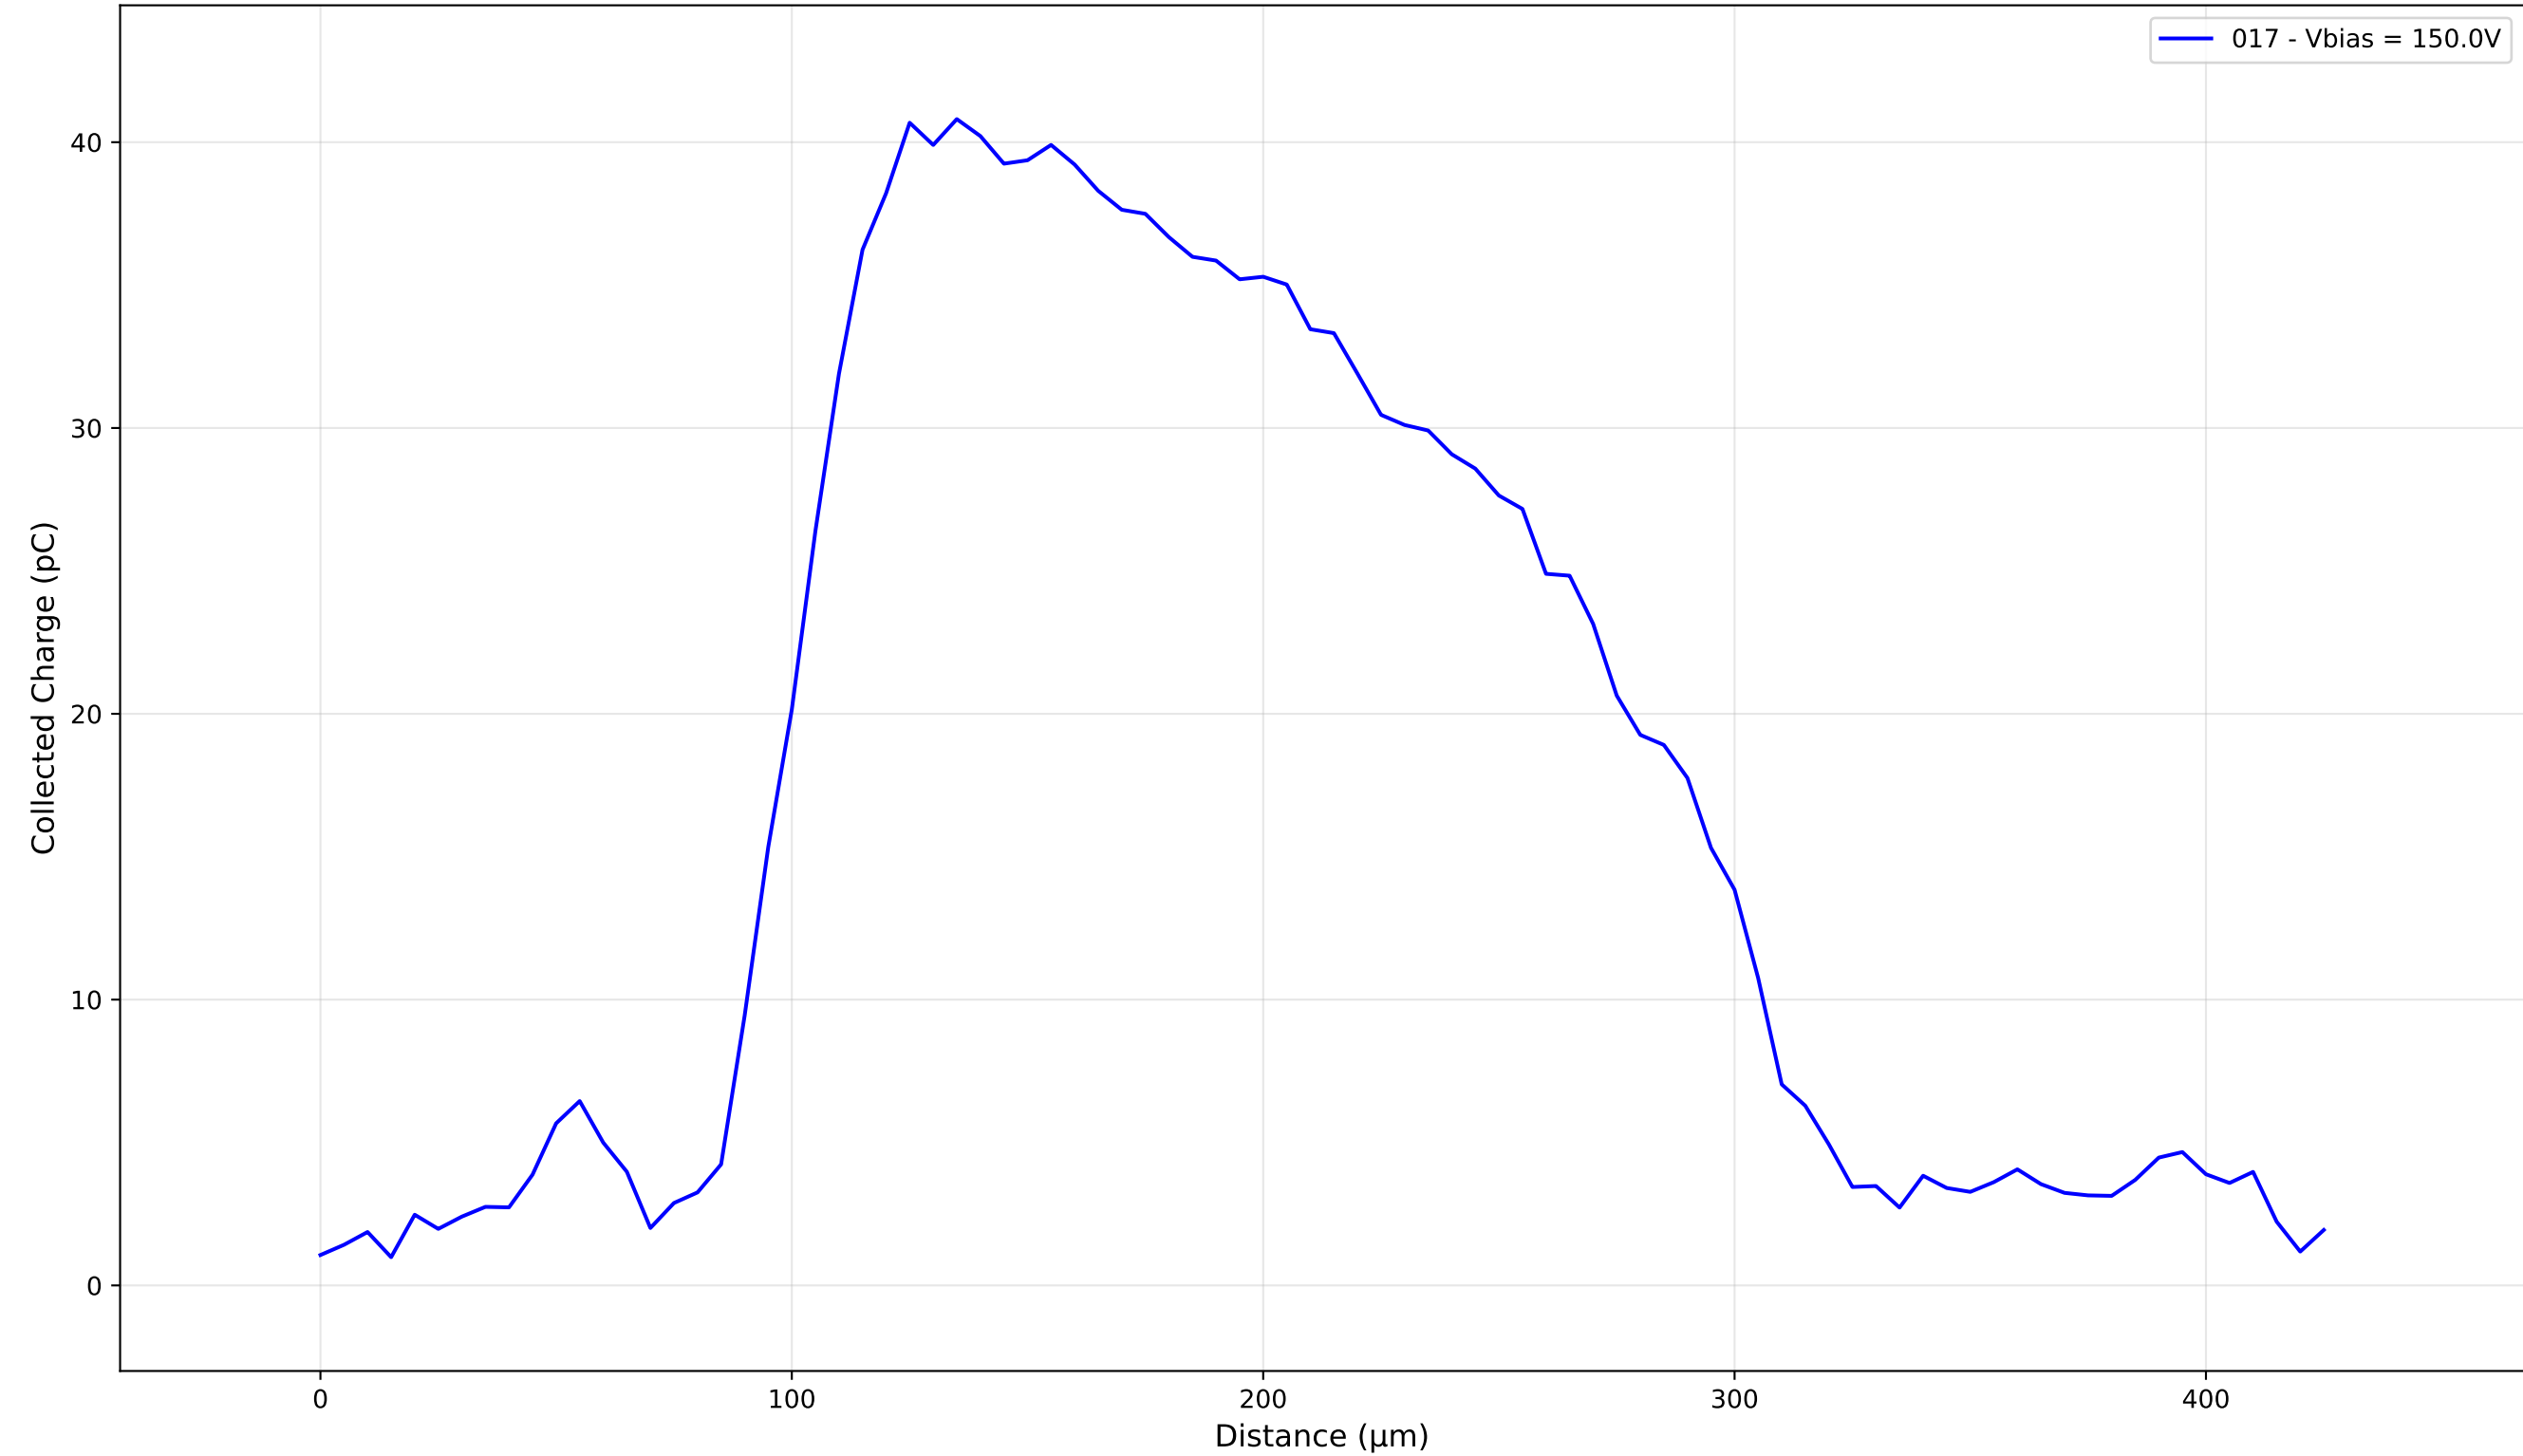

Collected Charge

017 - Vbias = 150.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

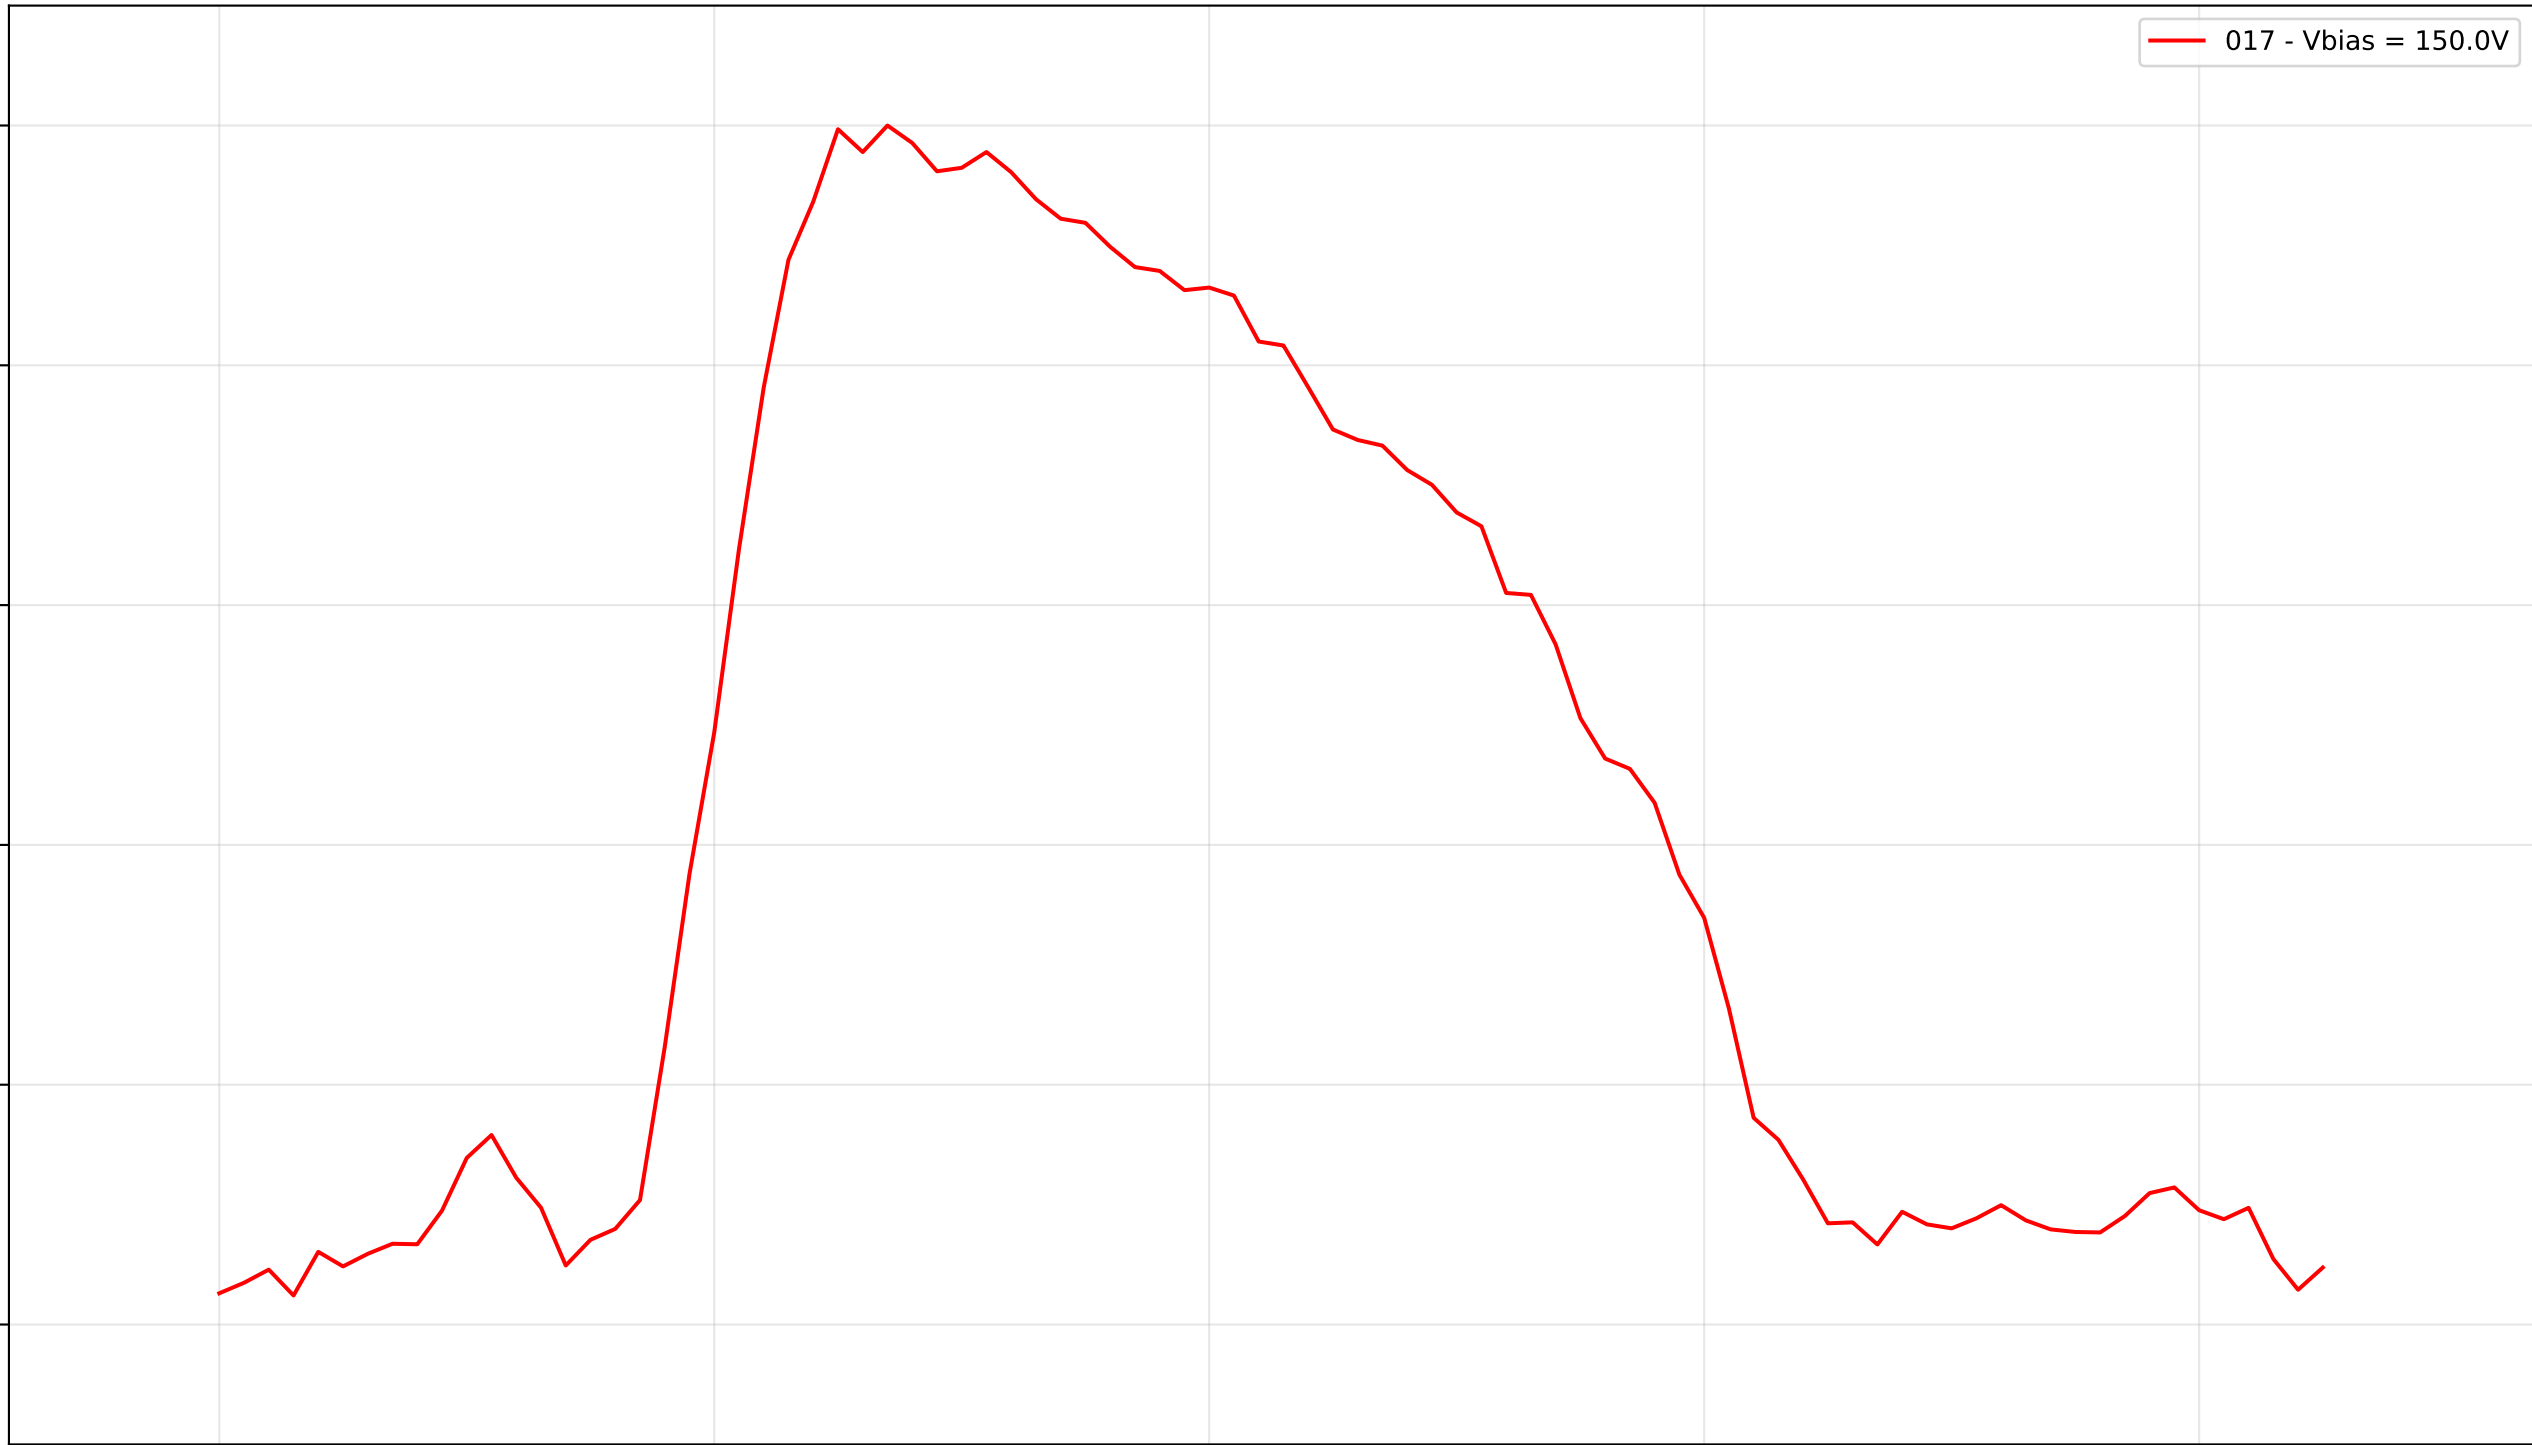


Rise Time

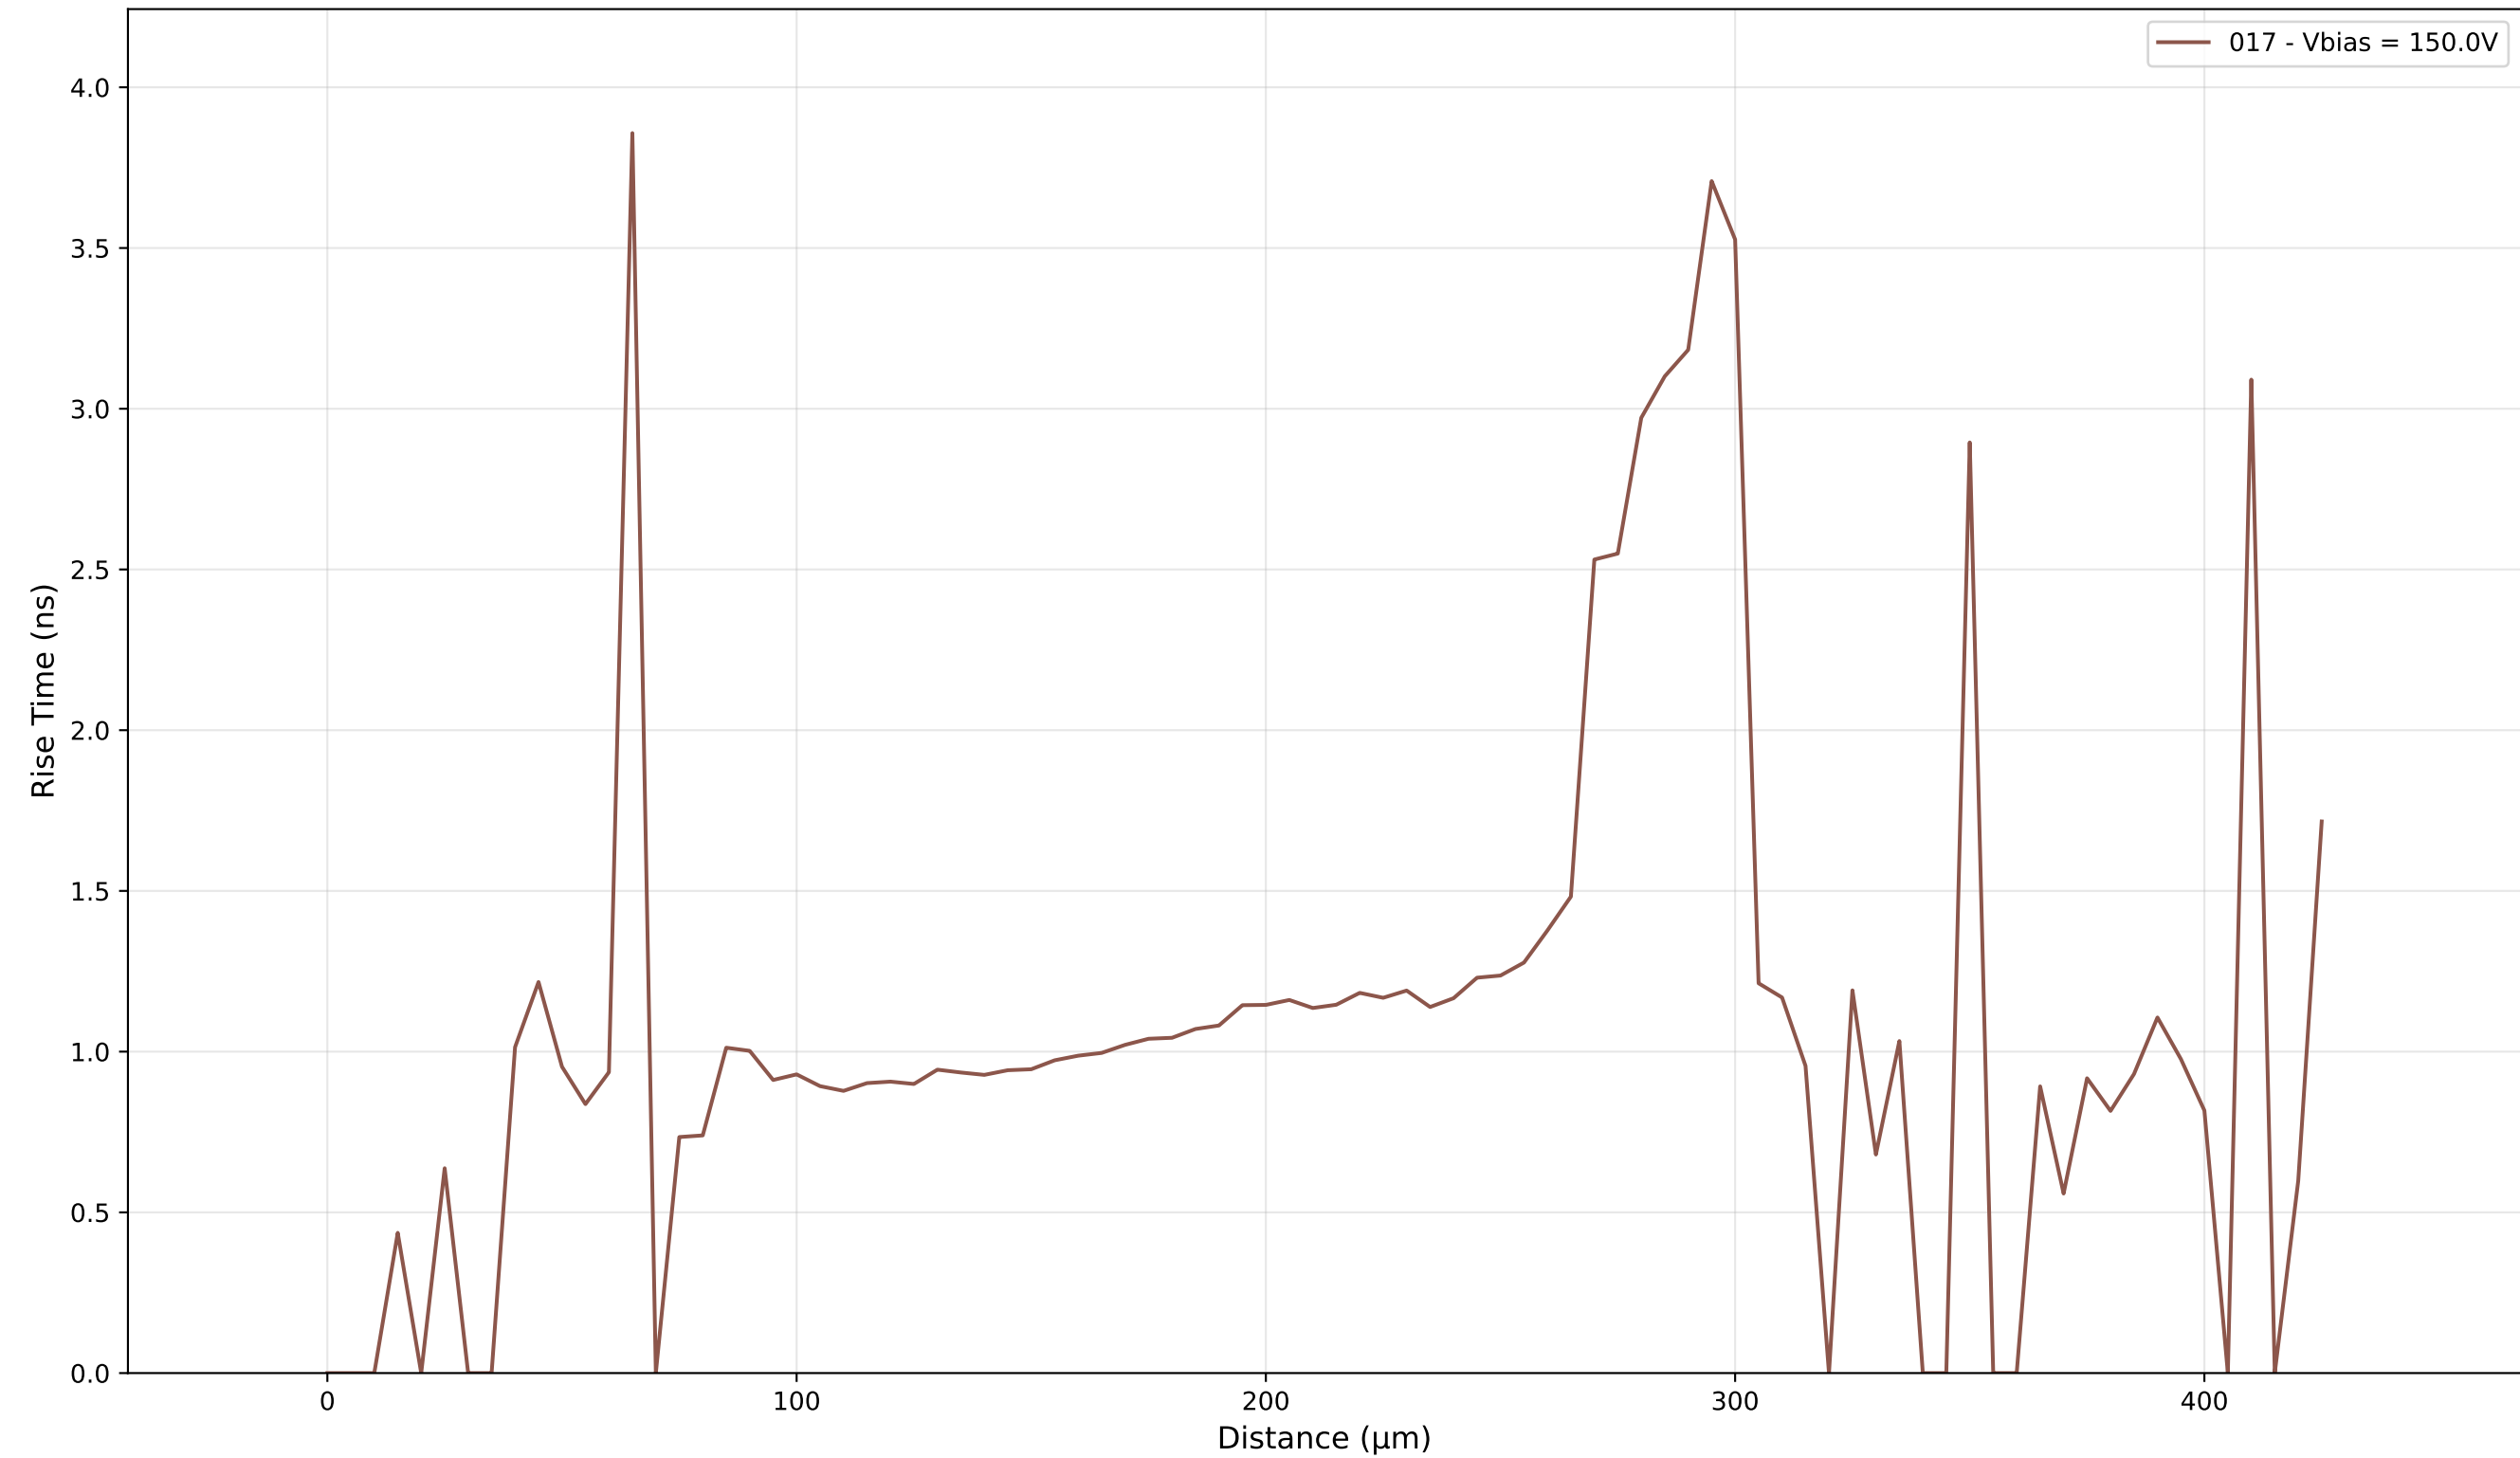


Amplitude

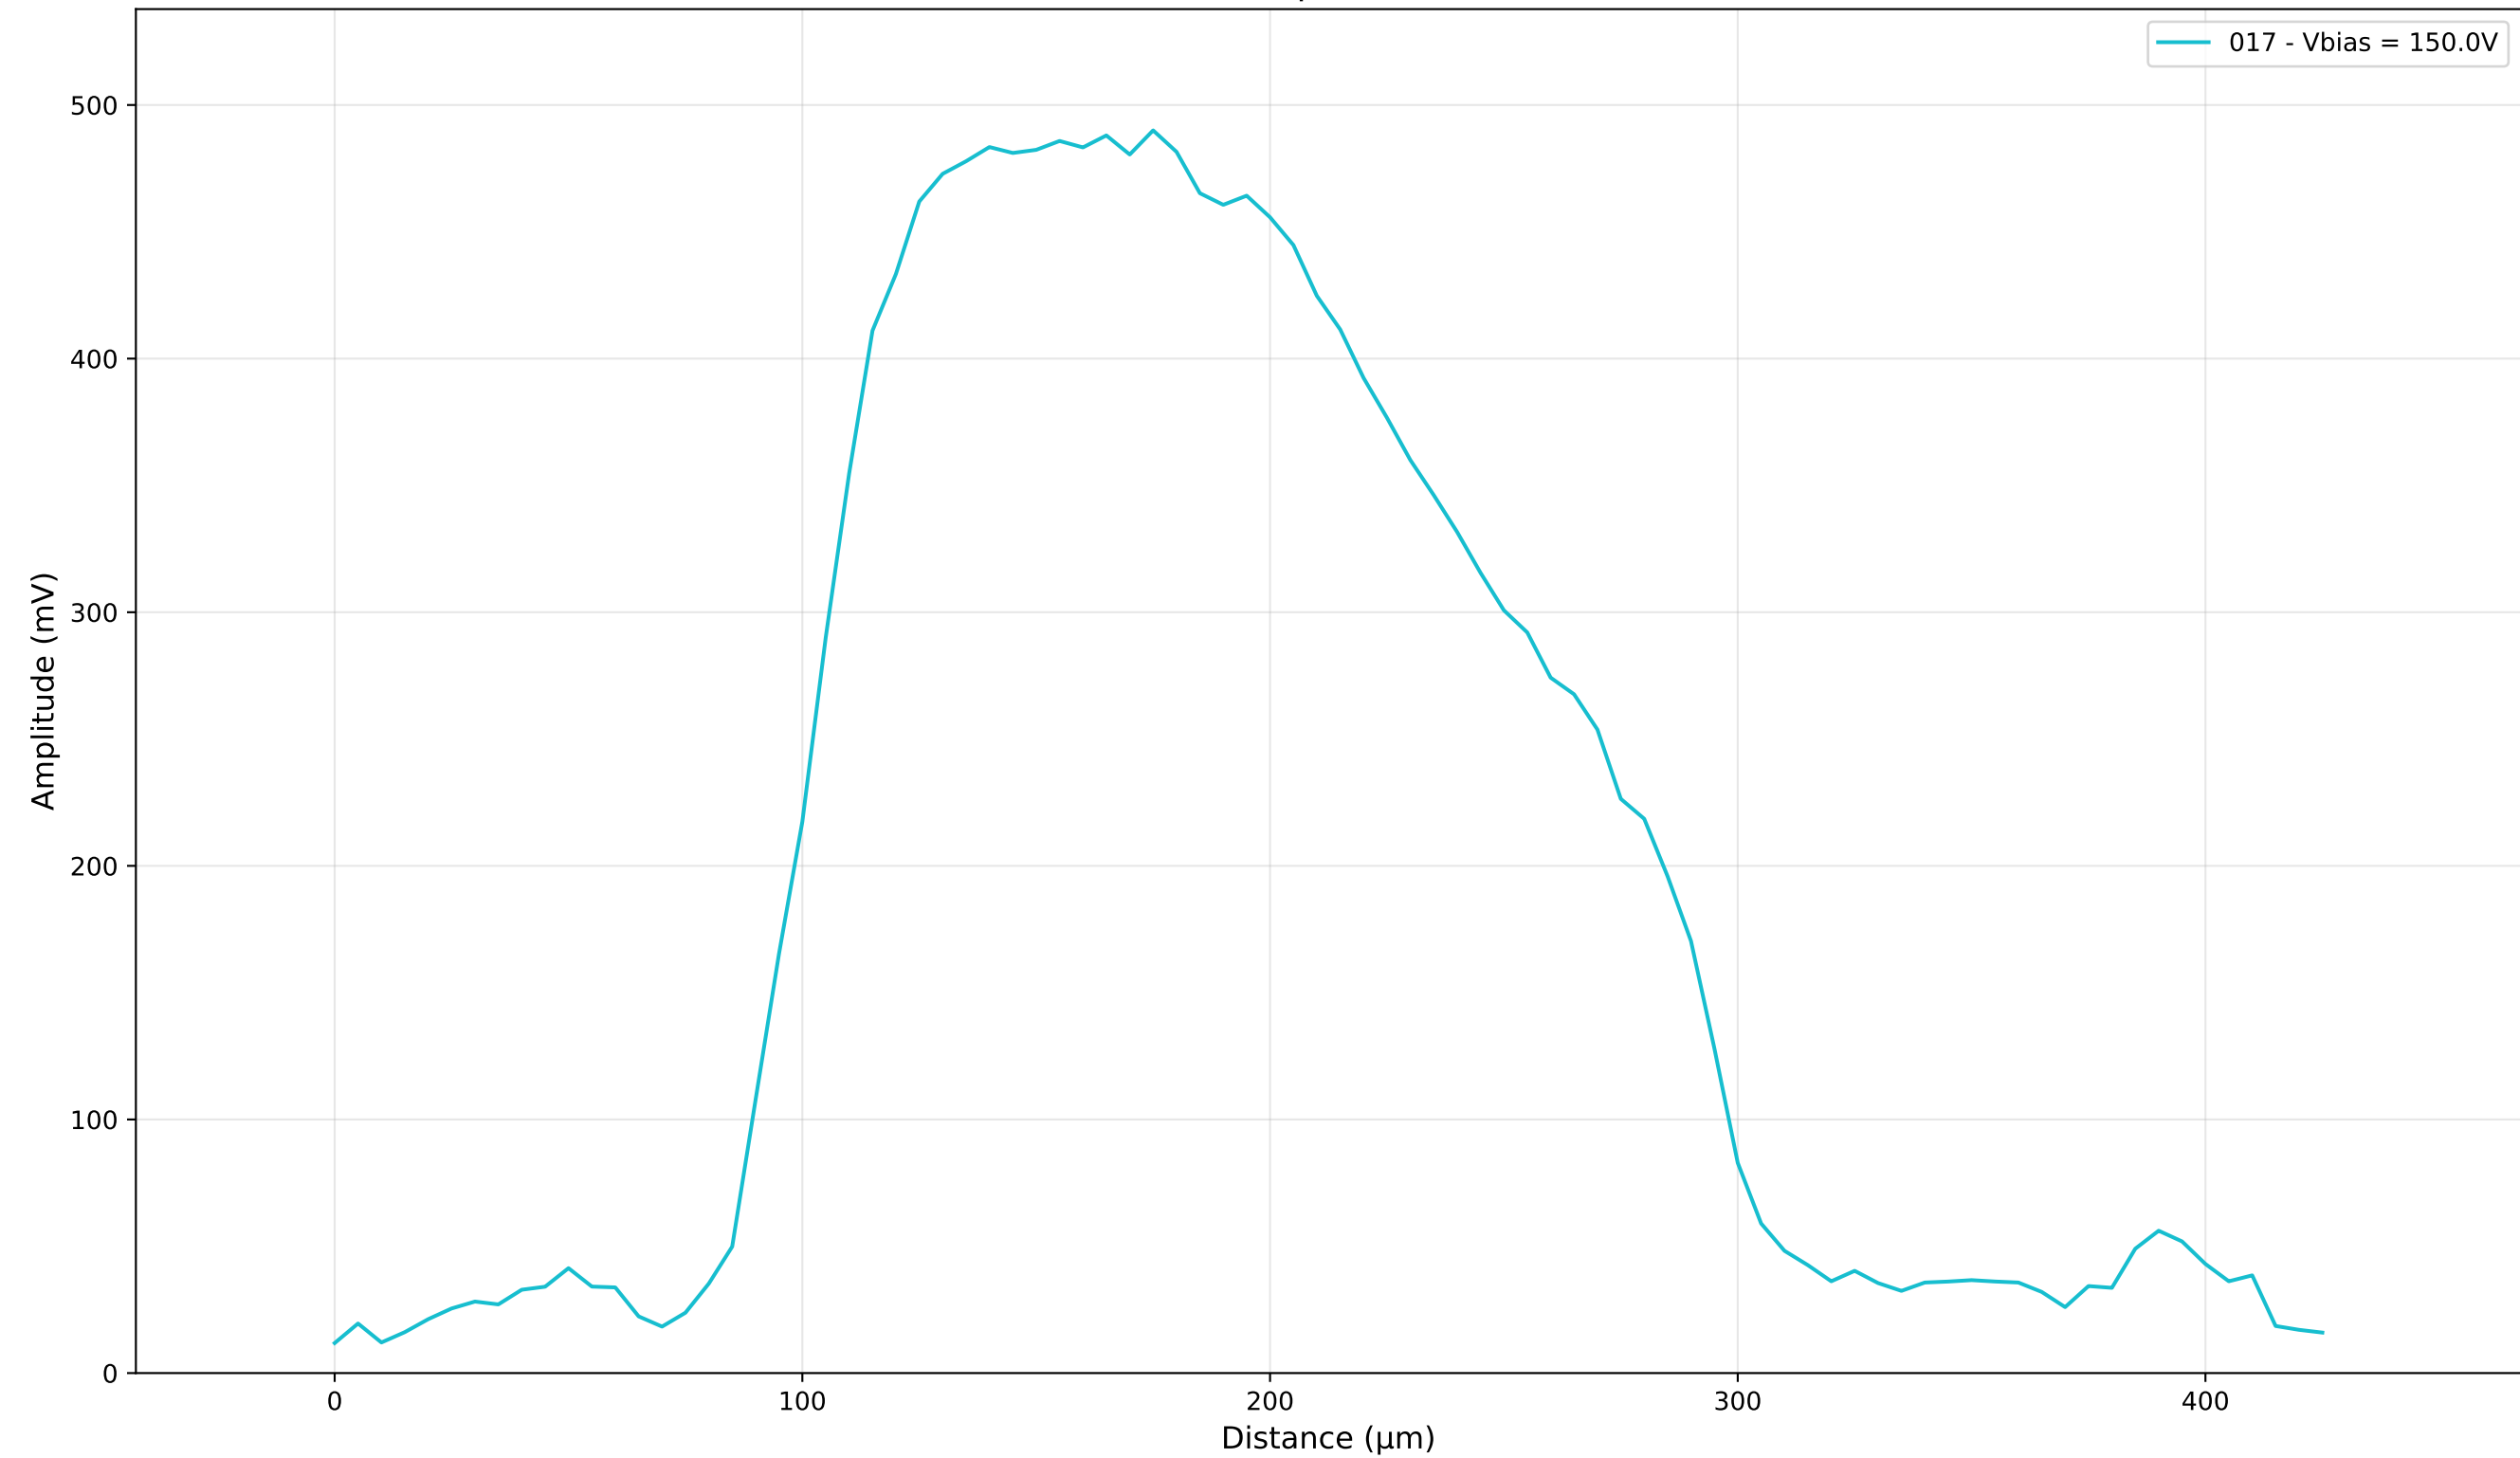


FWHM

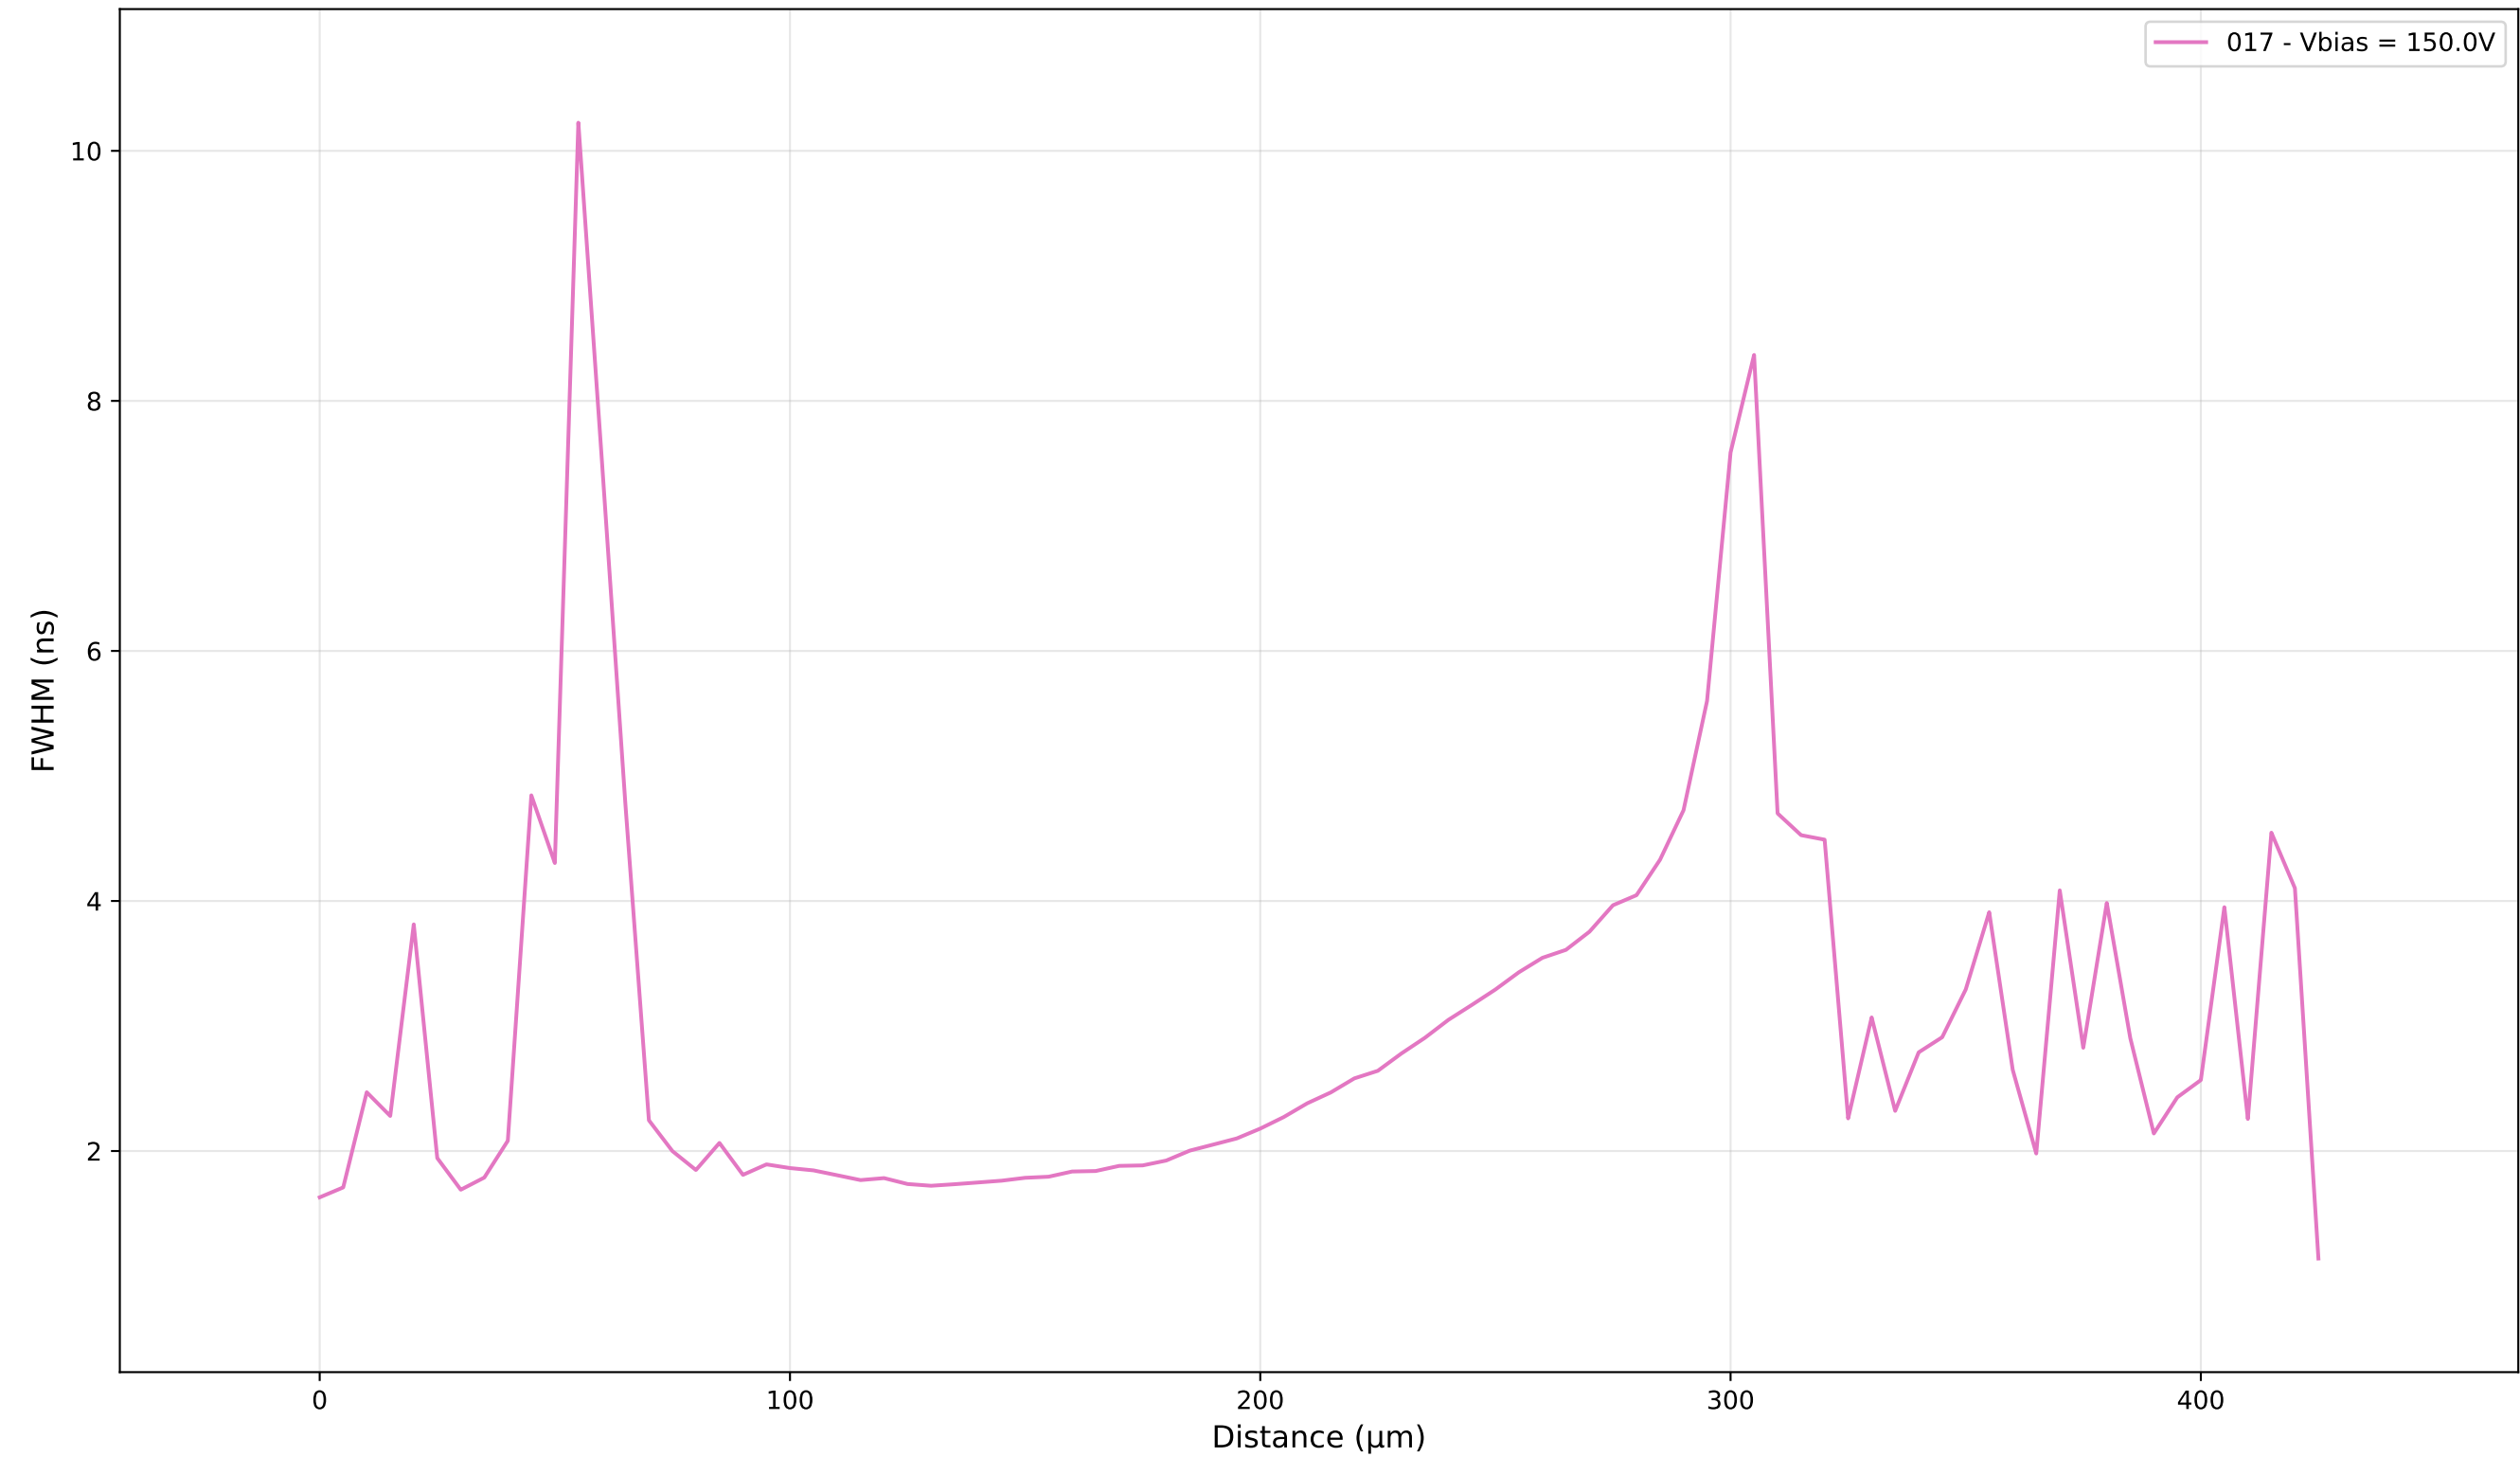


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 1.06 pC - Rise Time: 0.00 ns (N/A)

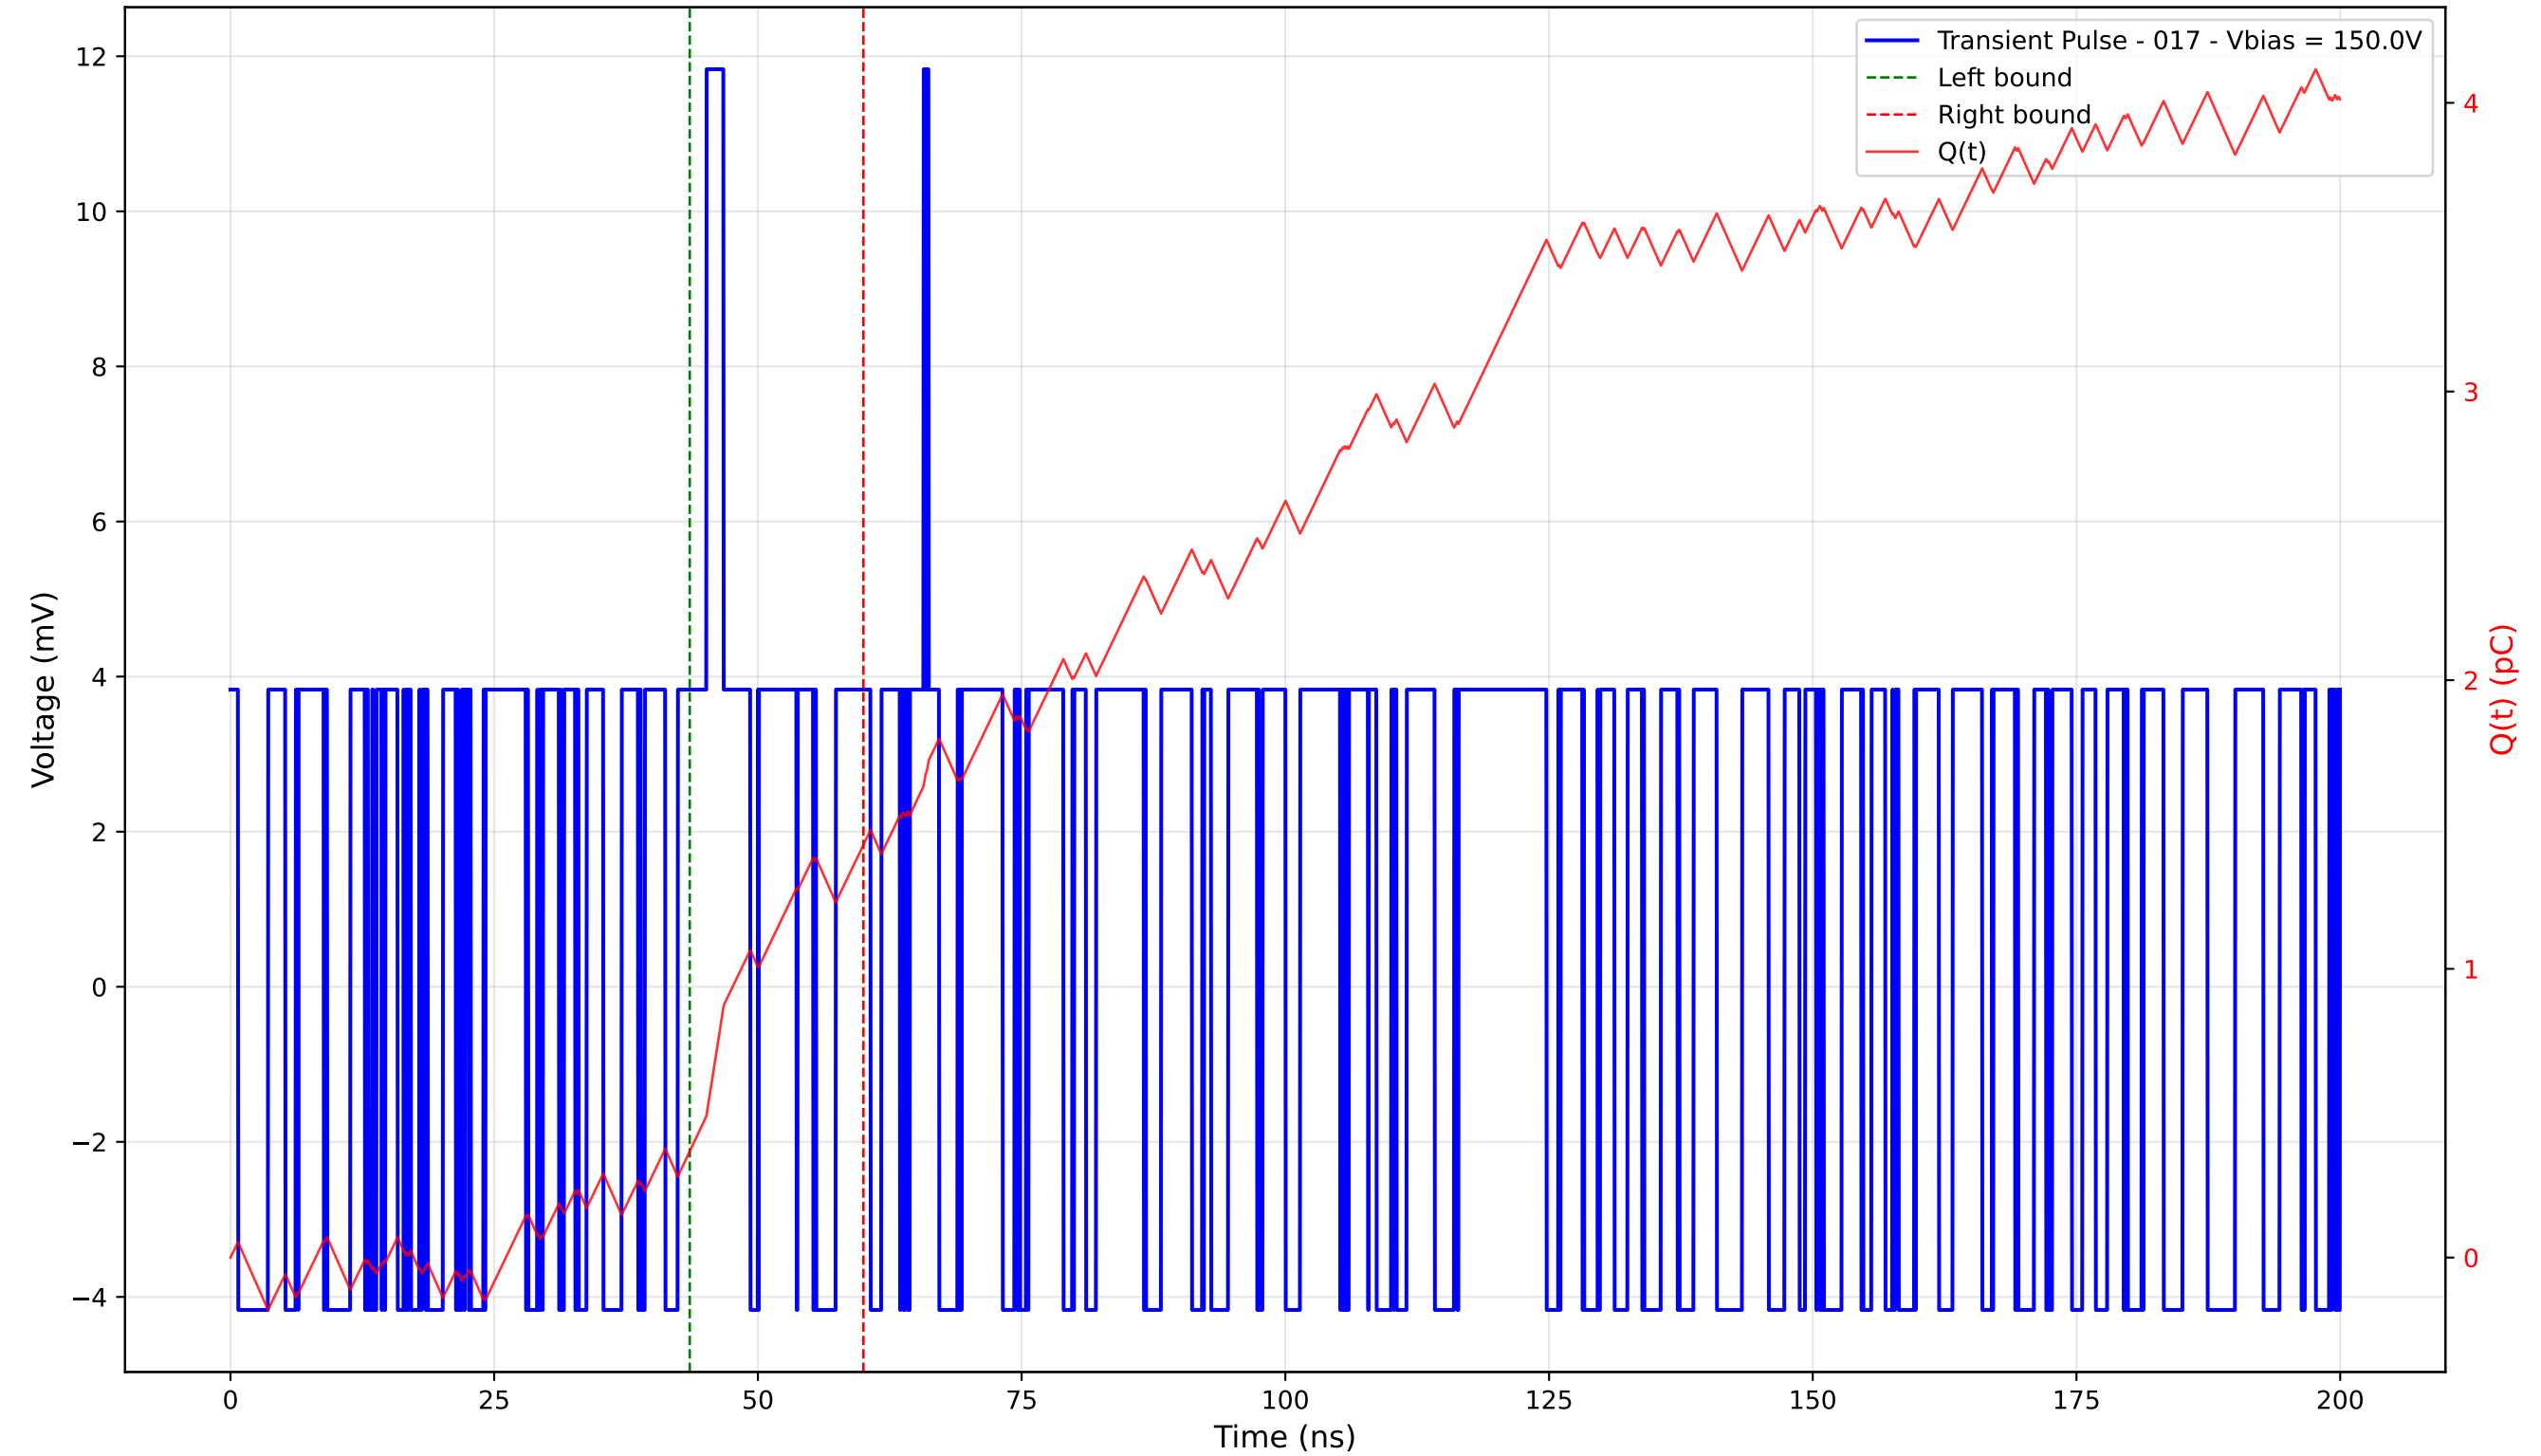


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 1.42 pC - Rise Time: 0.00 ns (N/A)

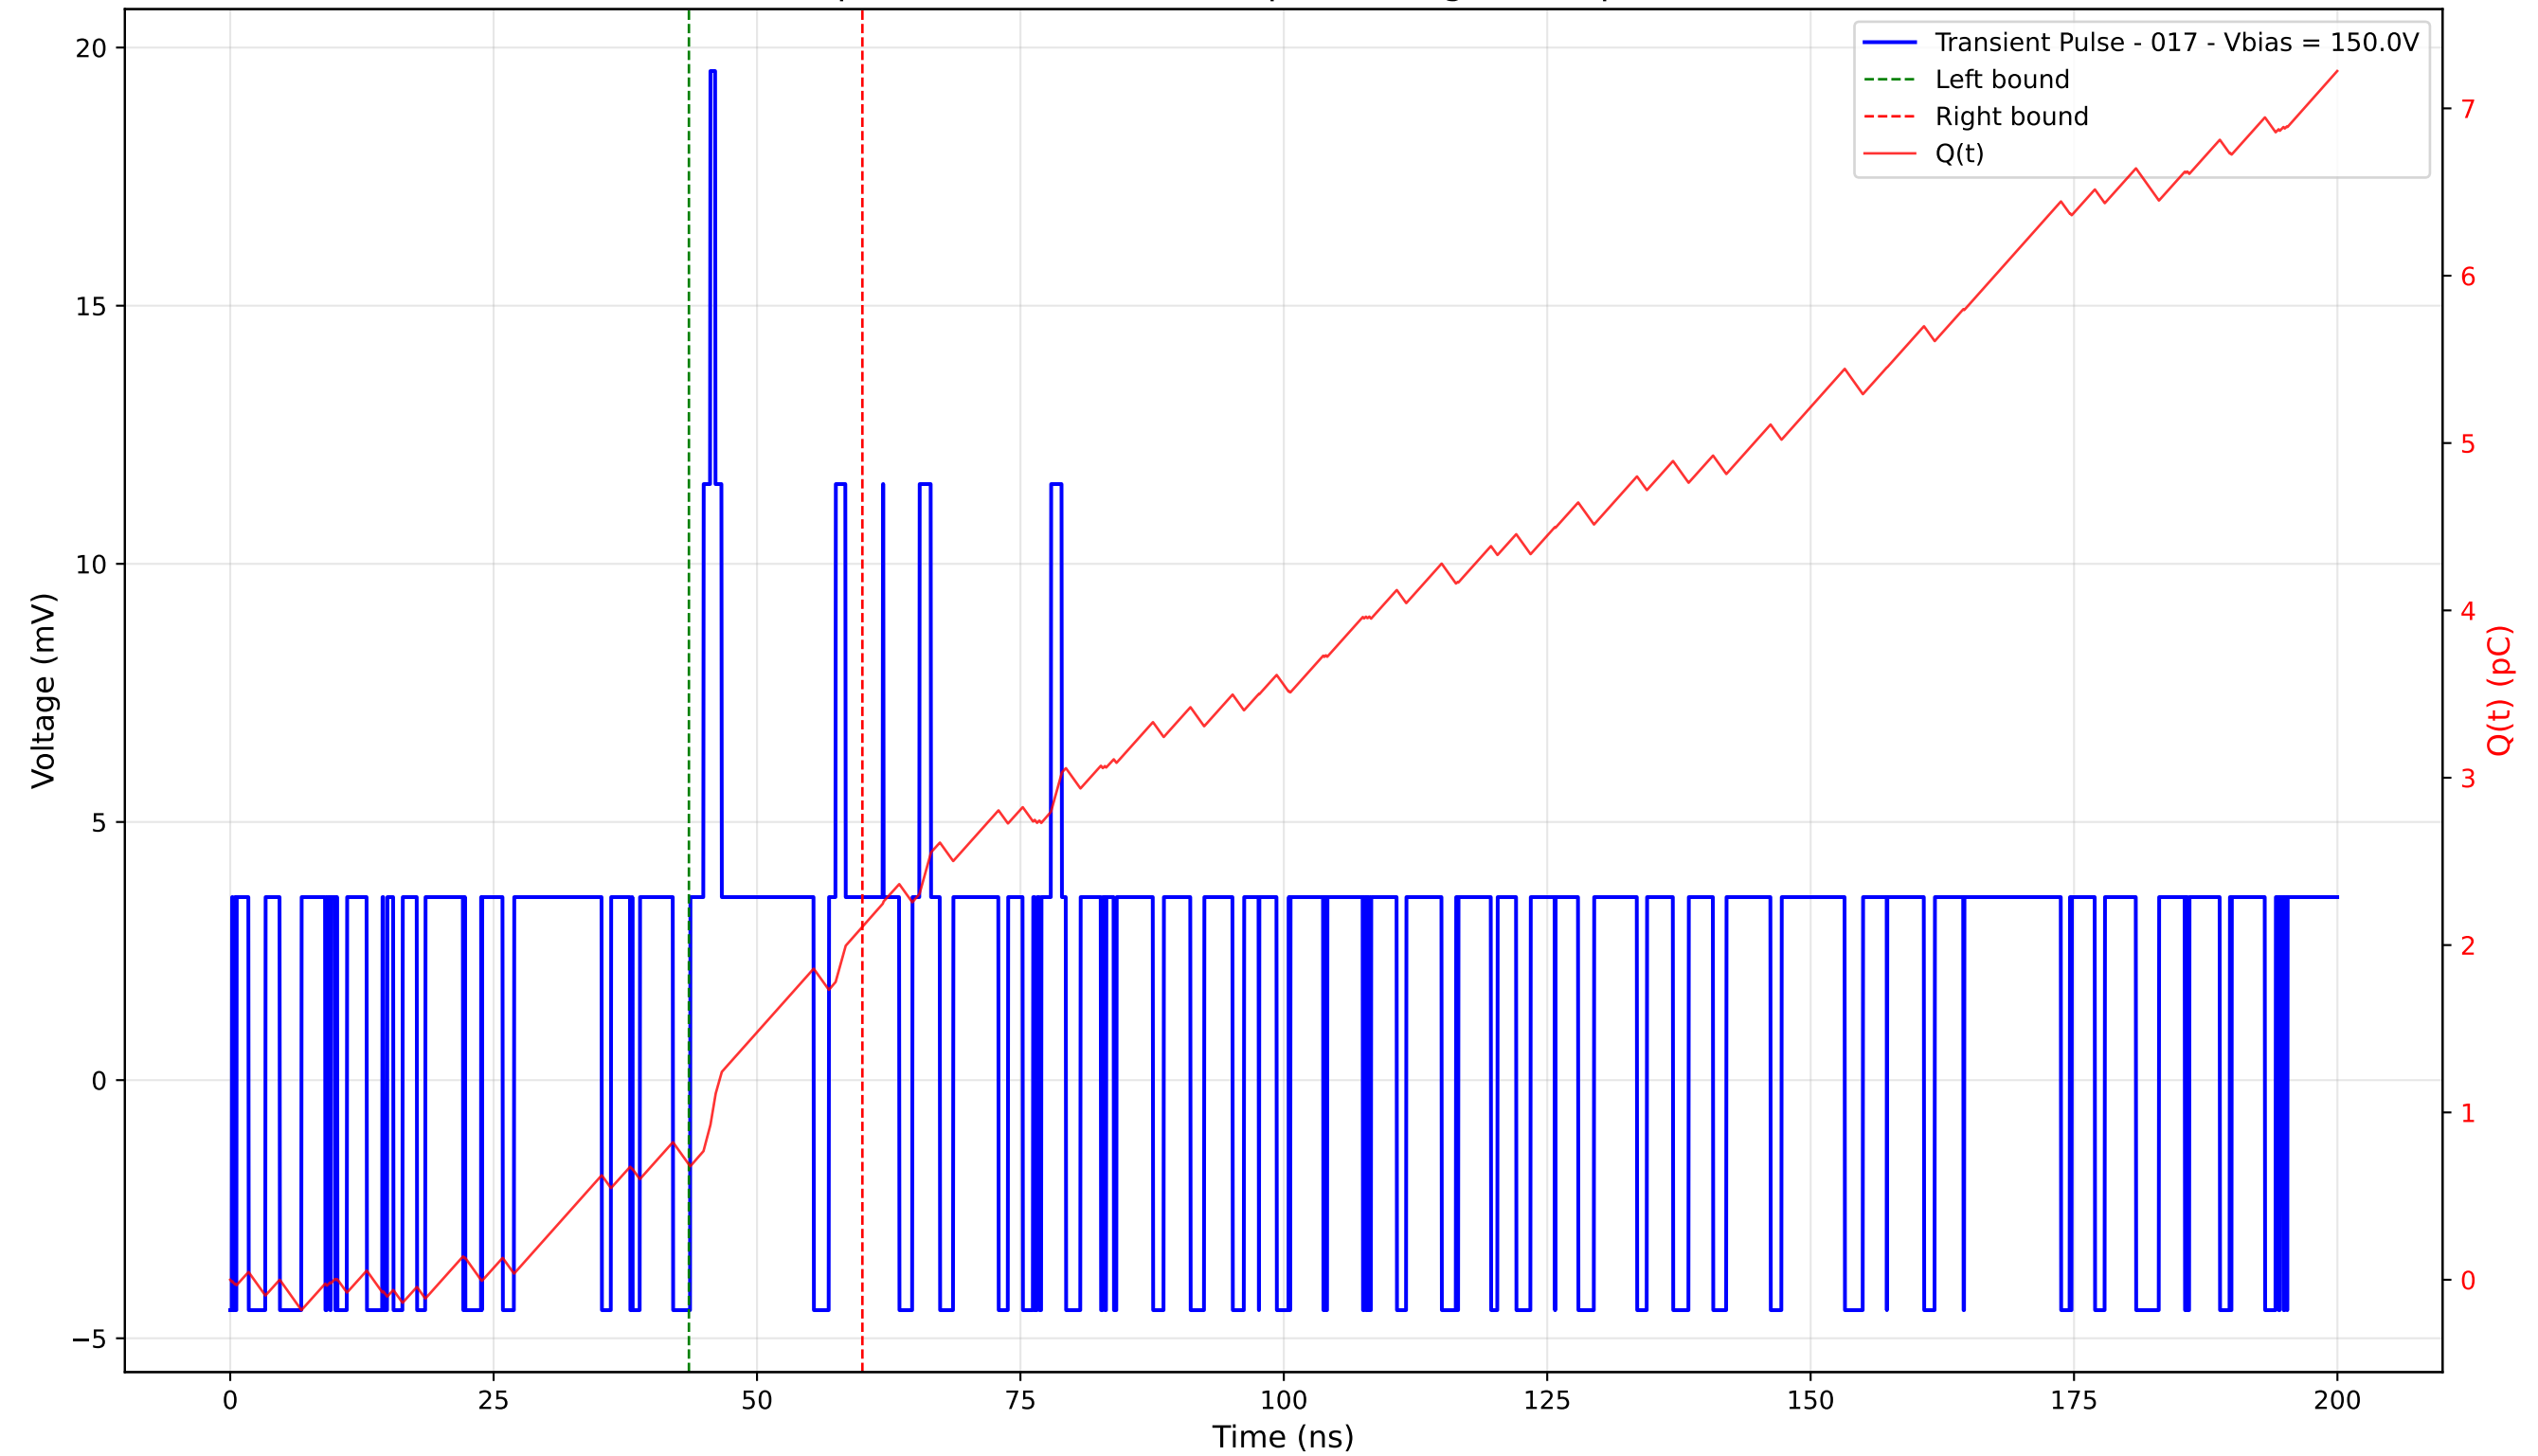


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 1.87 pC - Rise Time: 0.00 ns (N/A)

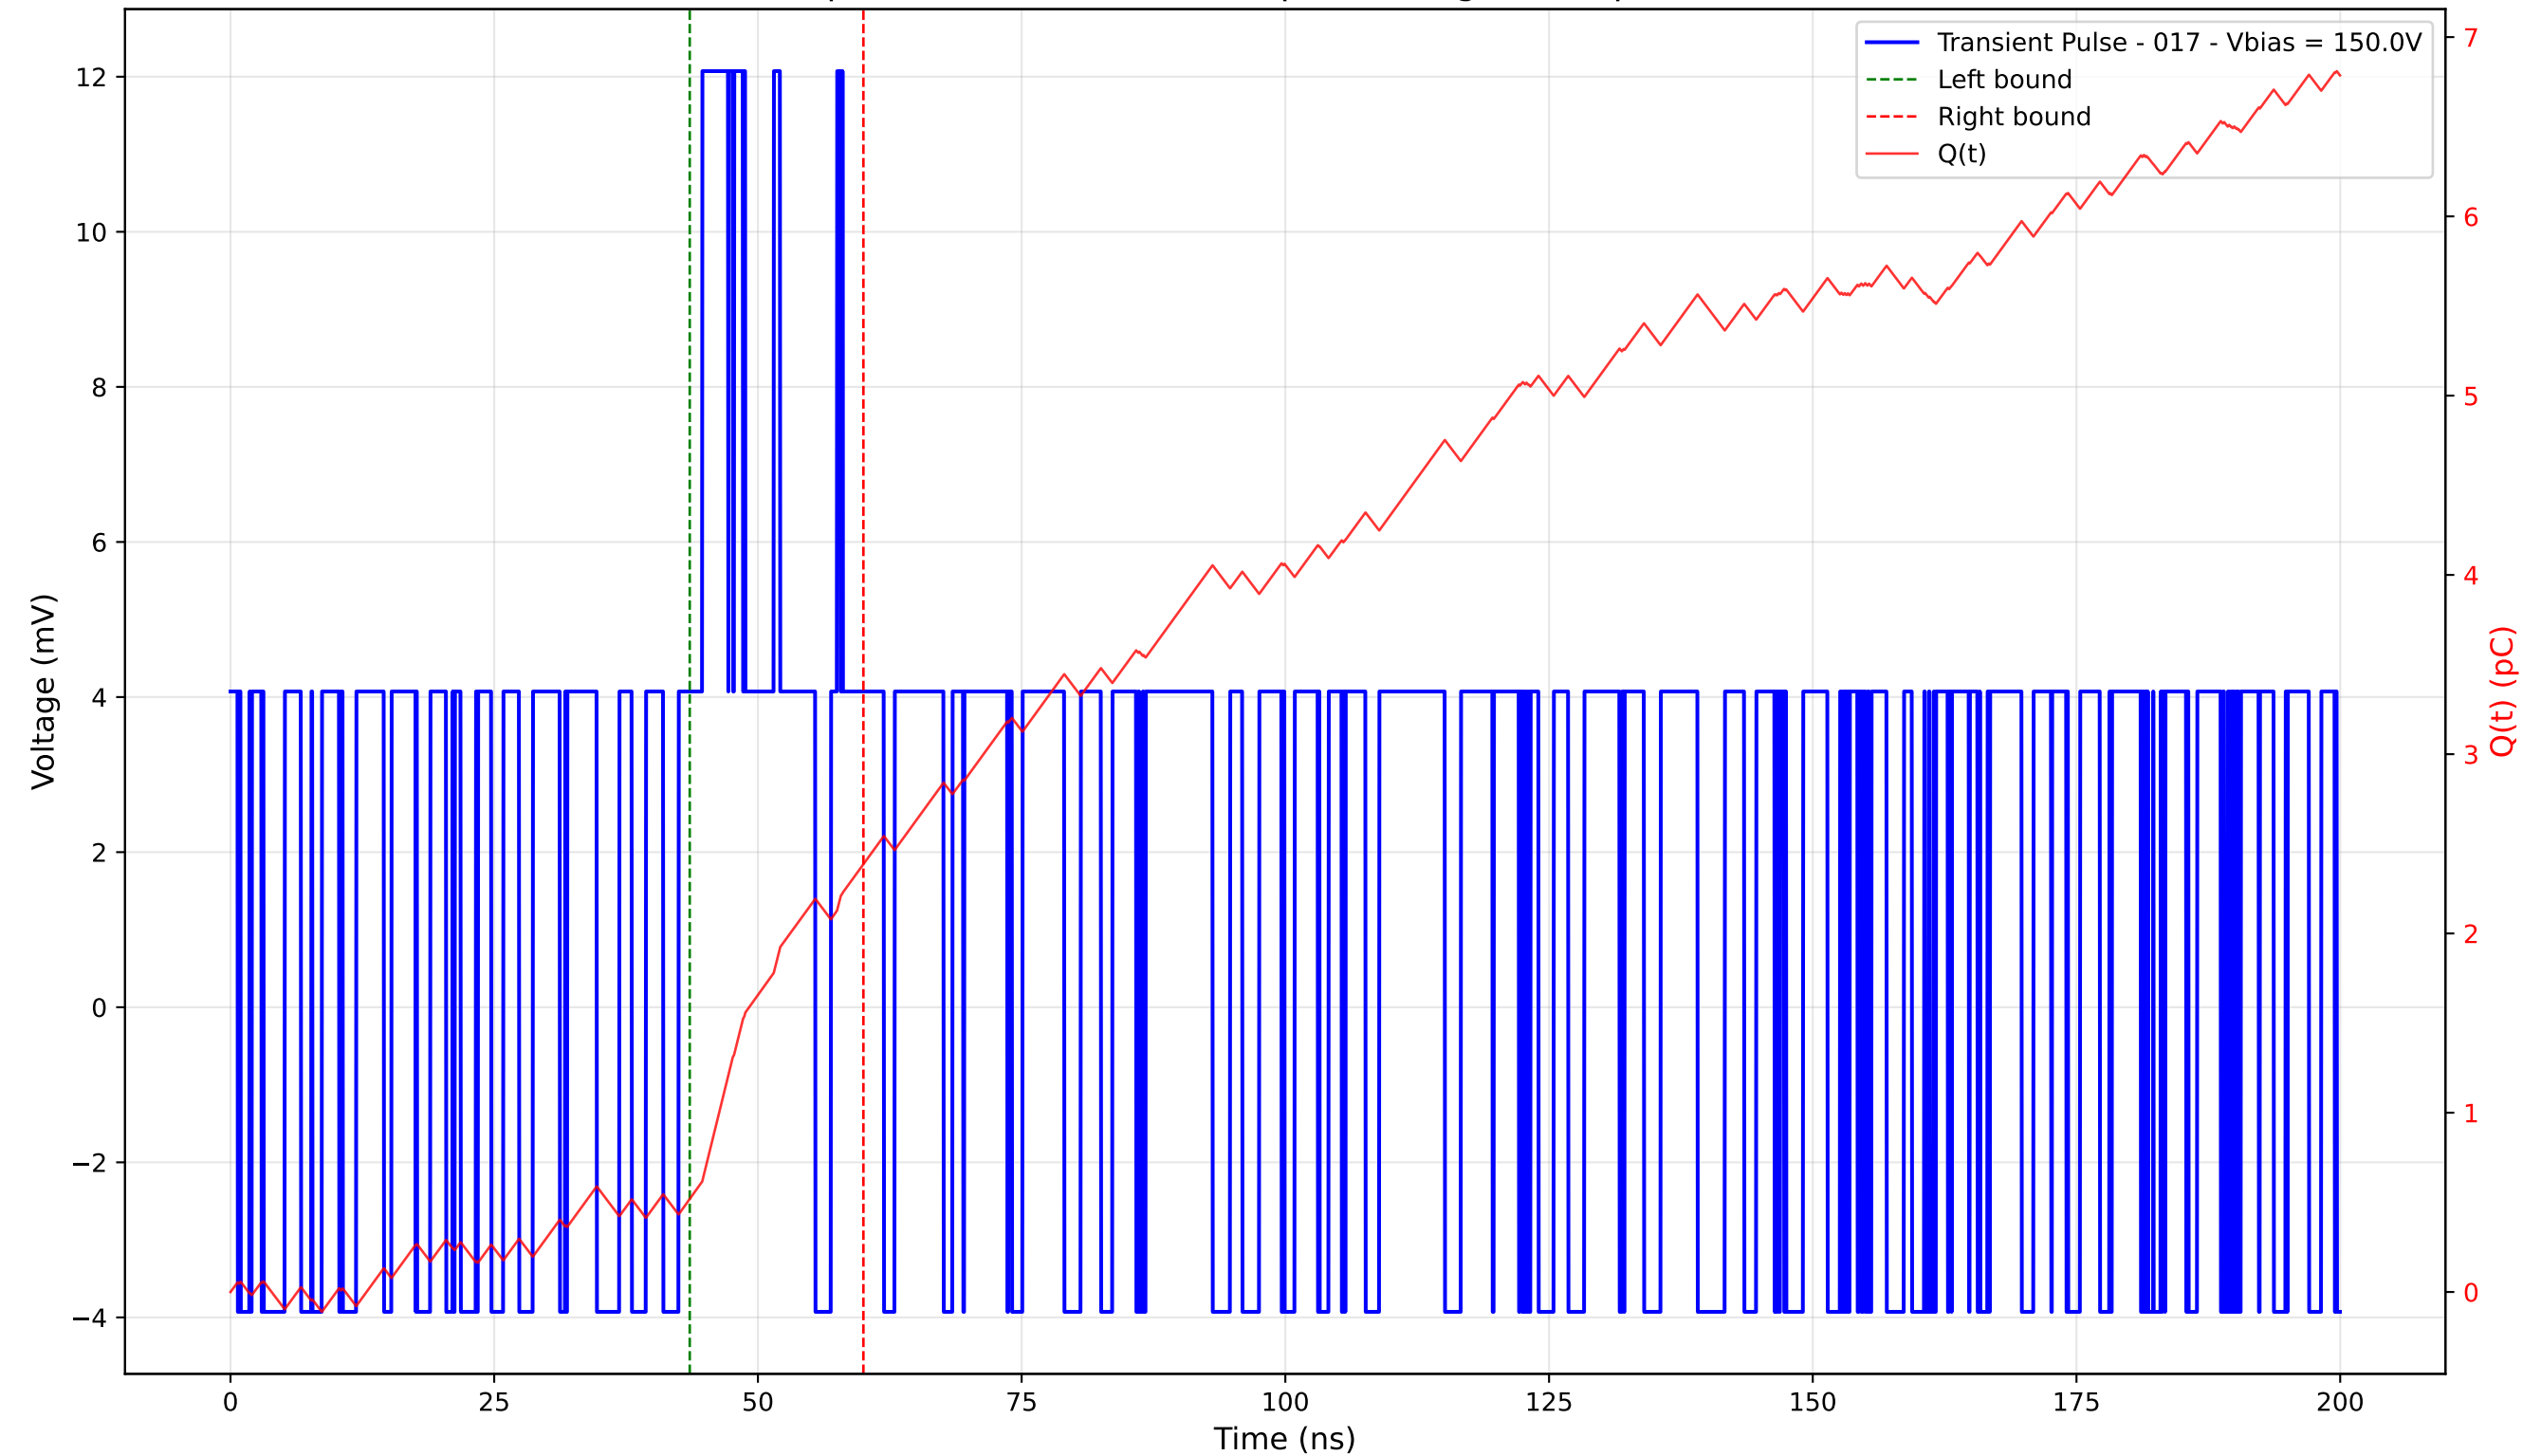


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 0.99 pC - Rise Time: 0.44 ns

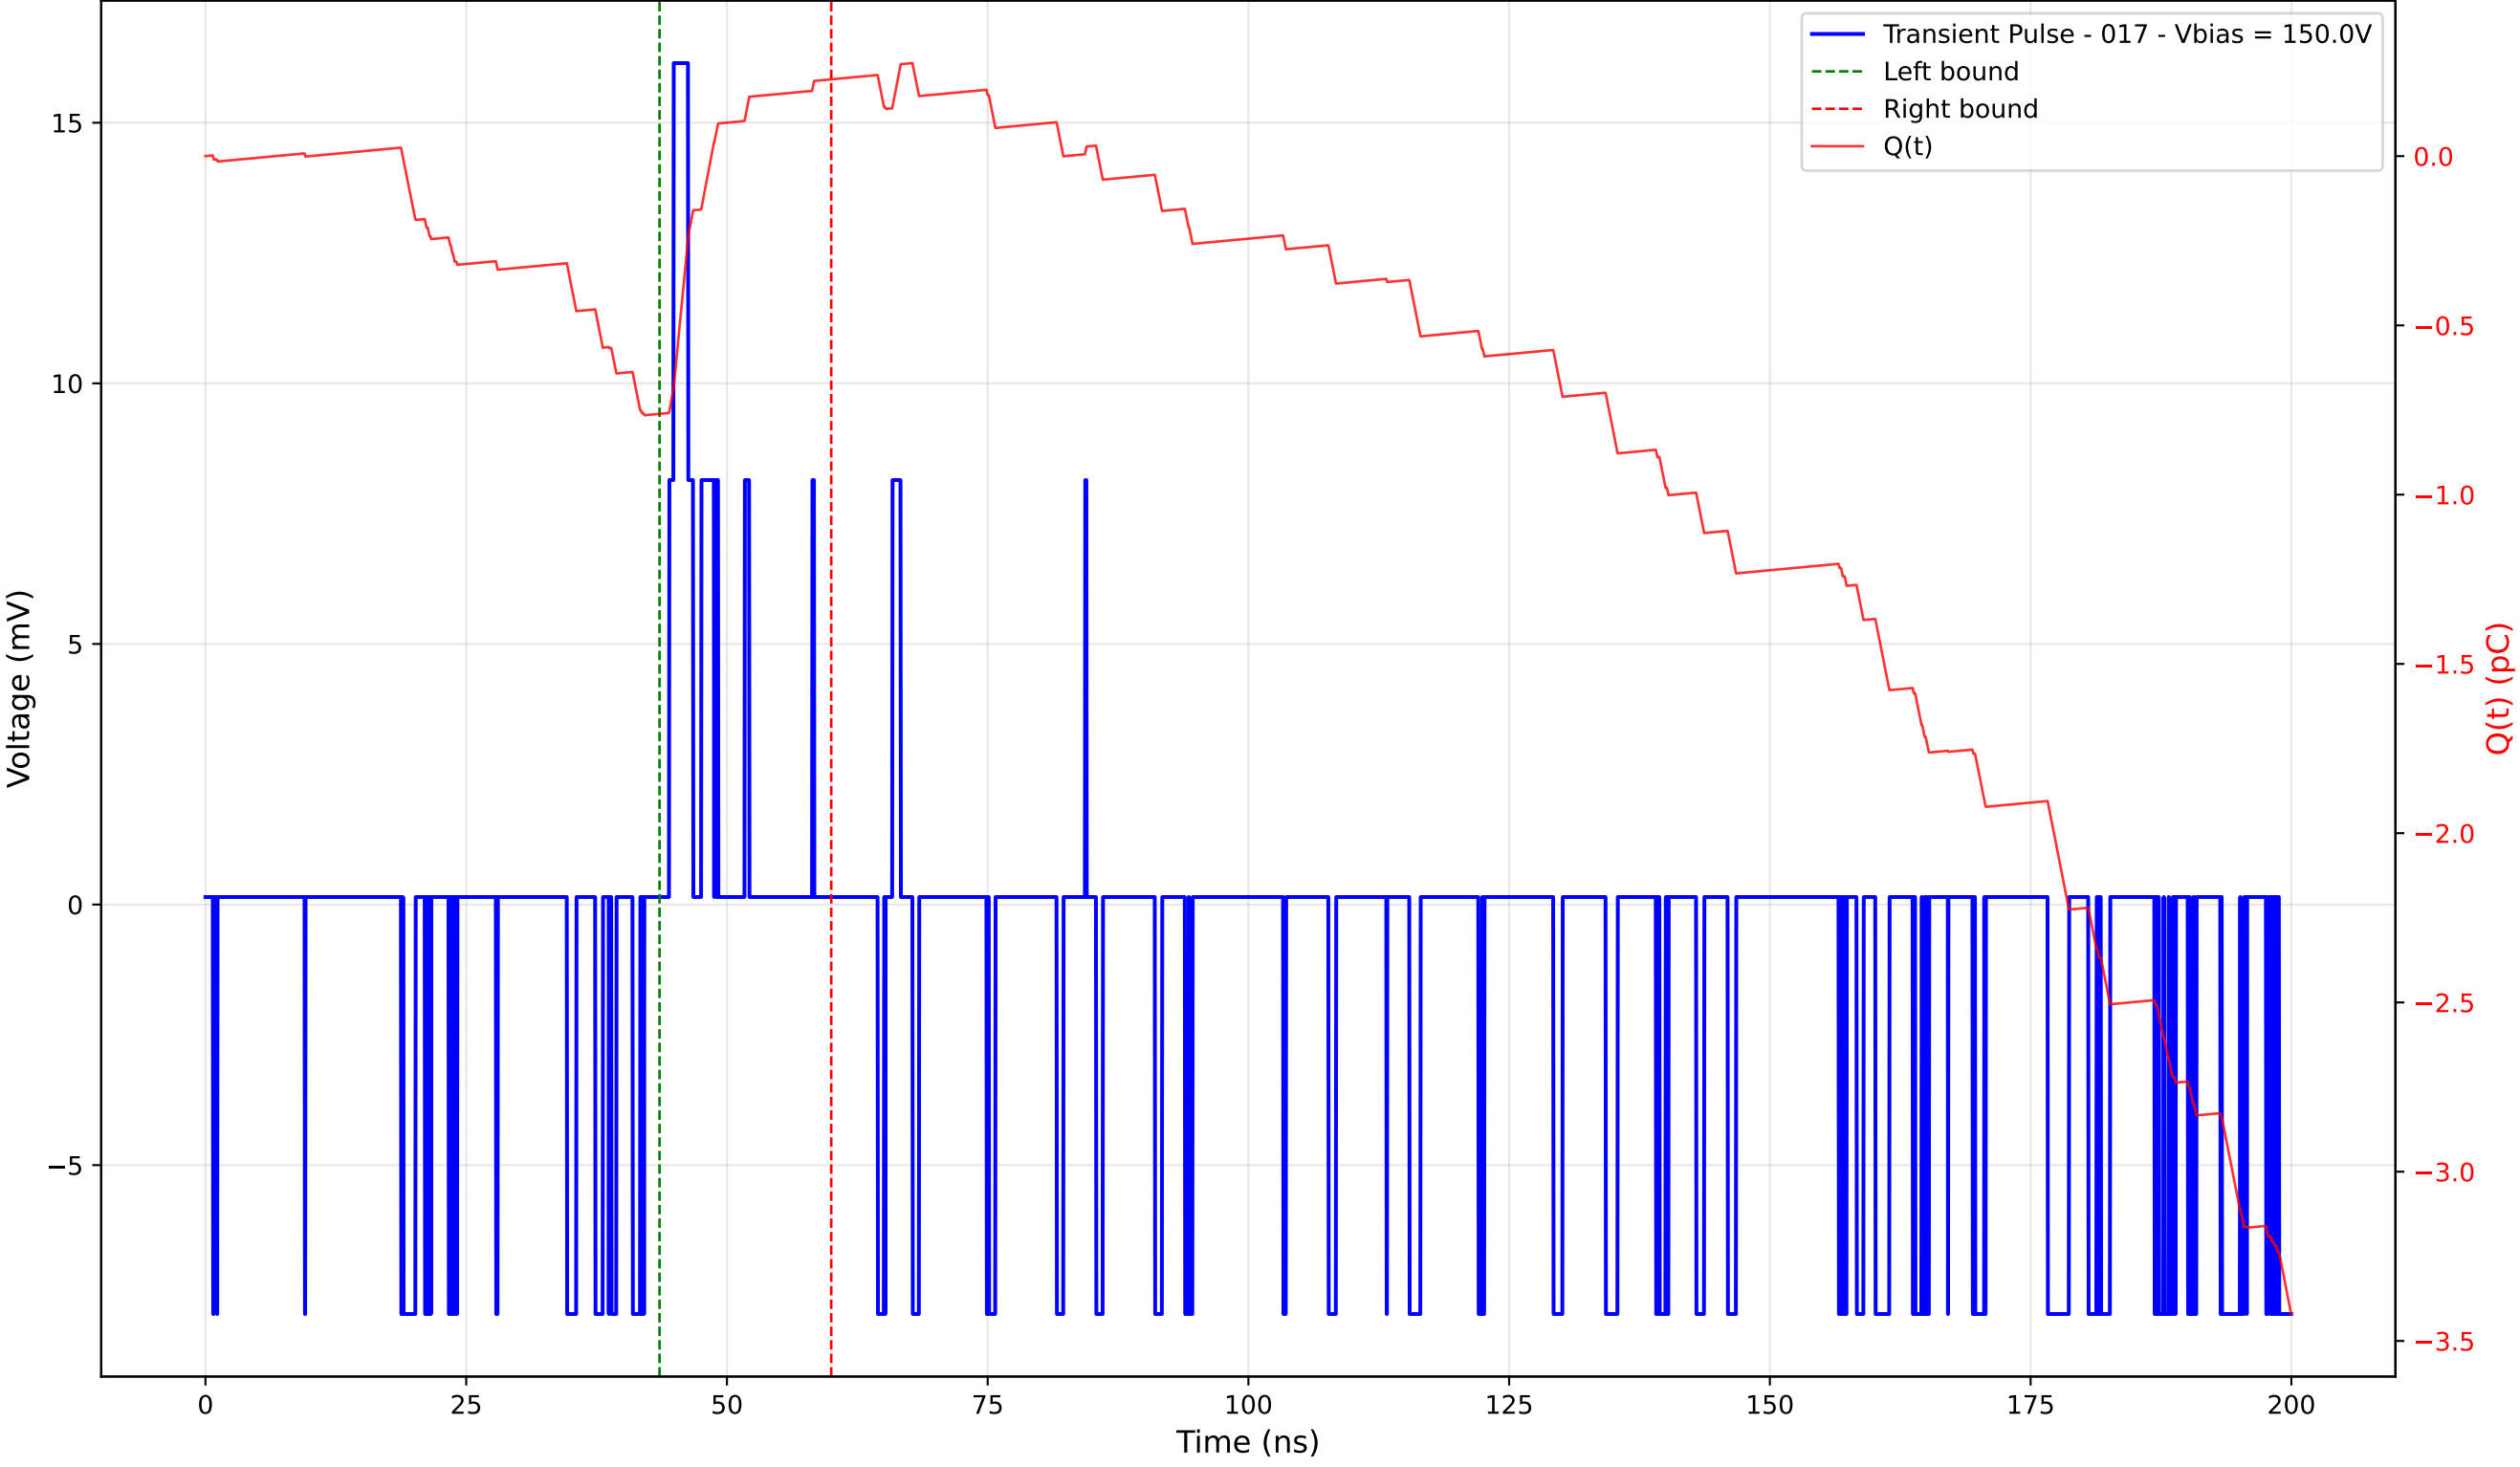


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 2.47 pC - Rise Time: 0.00 ns (N/A)

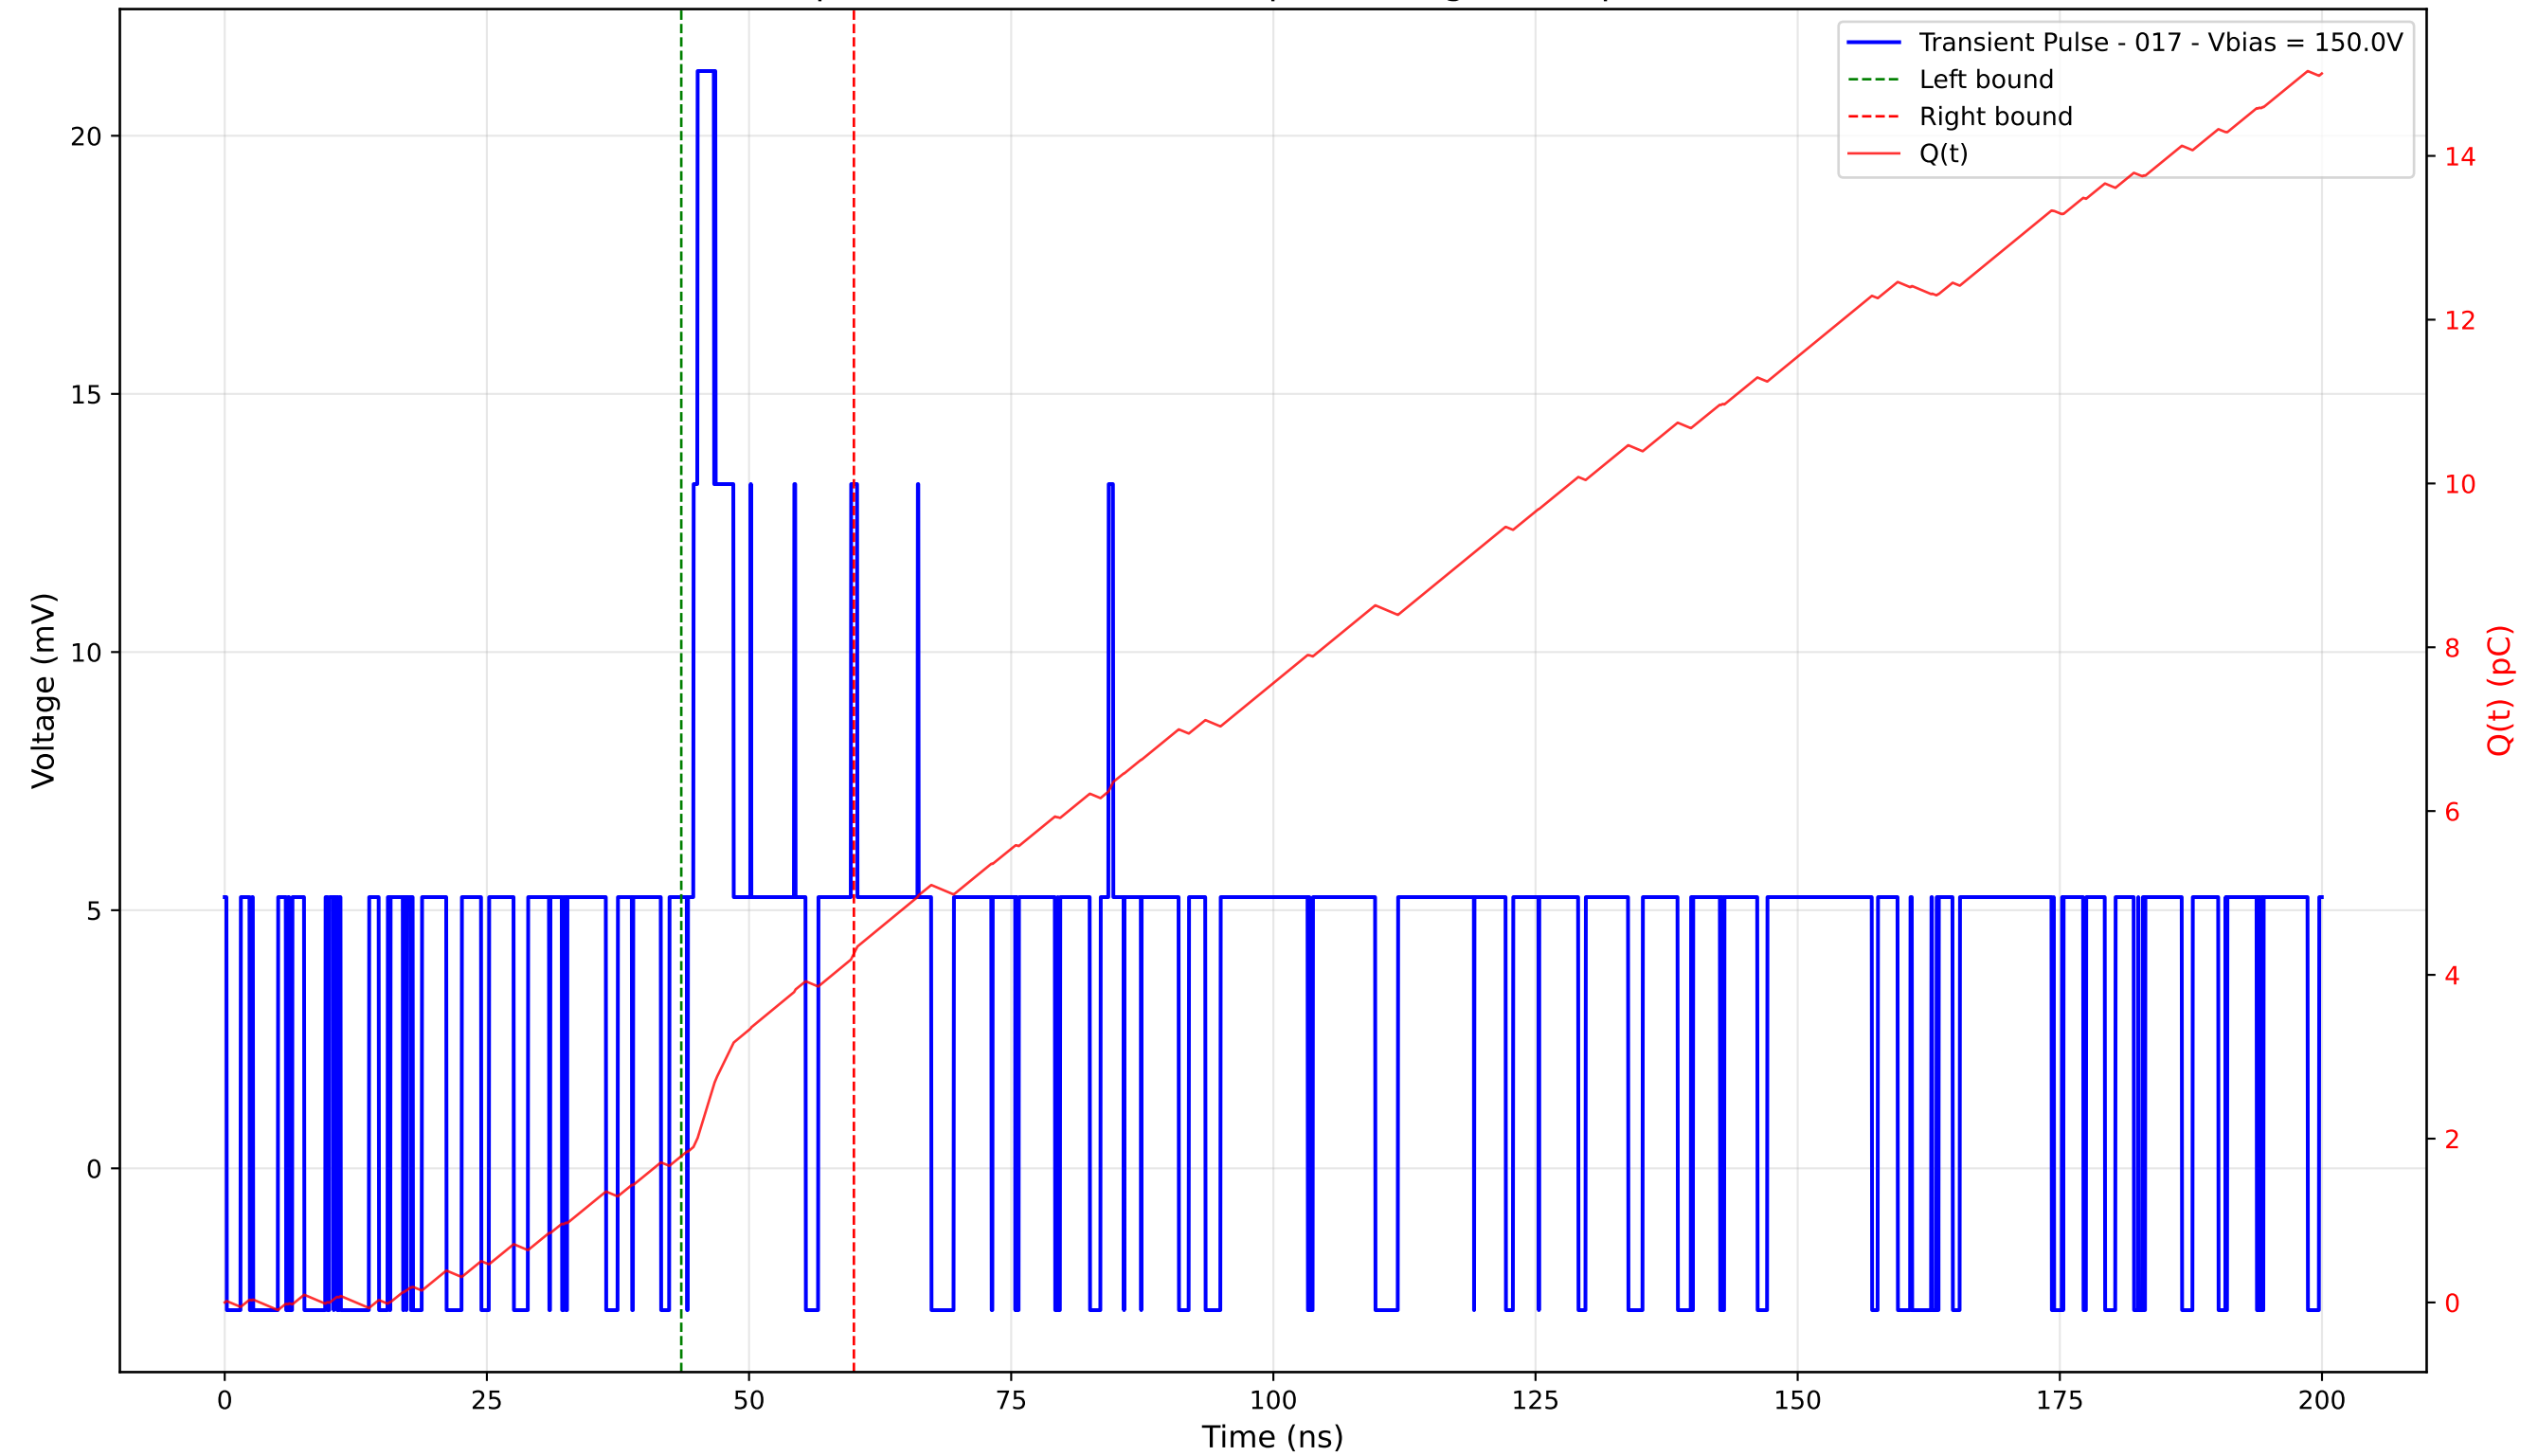


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.98 pC - Rise Time: 0.64 ns

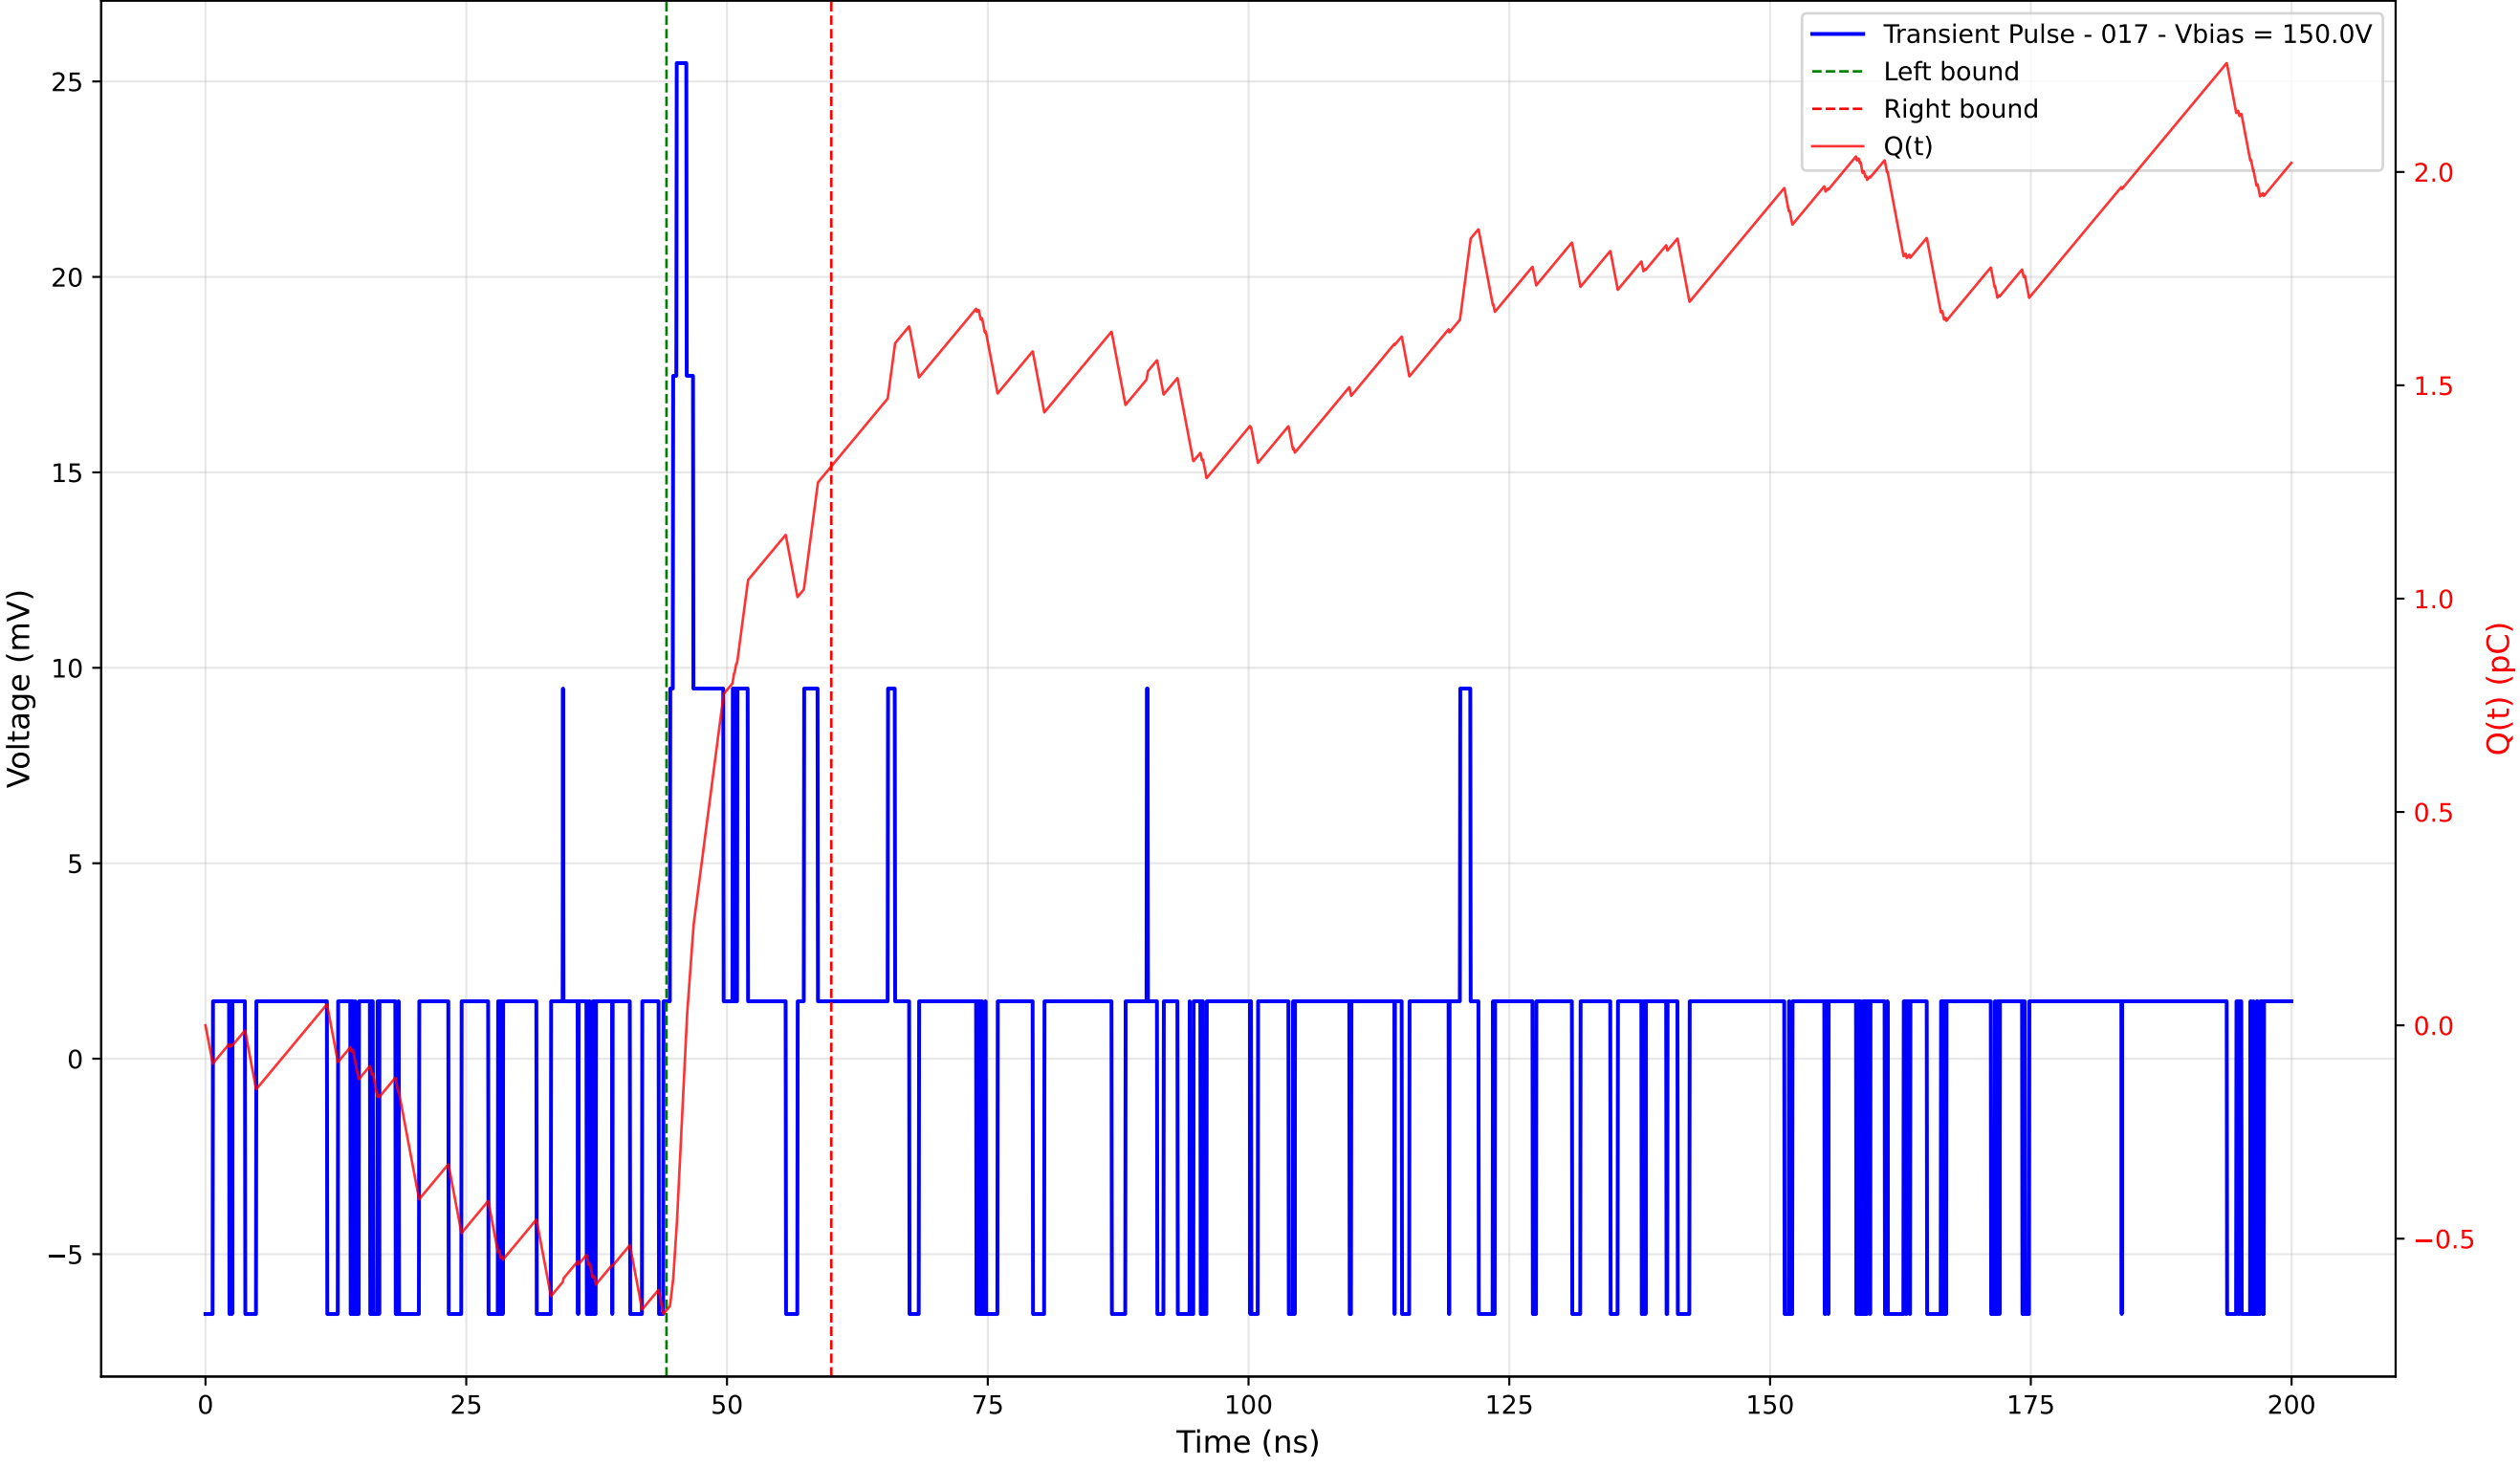


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 2.41 pC - Rise Time: 0.00 ns (N/A)

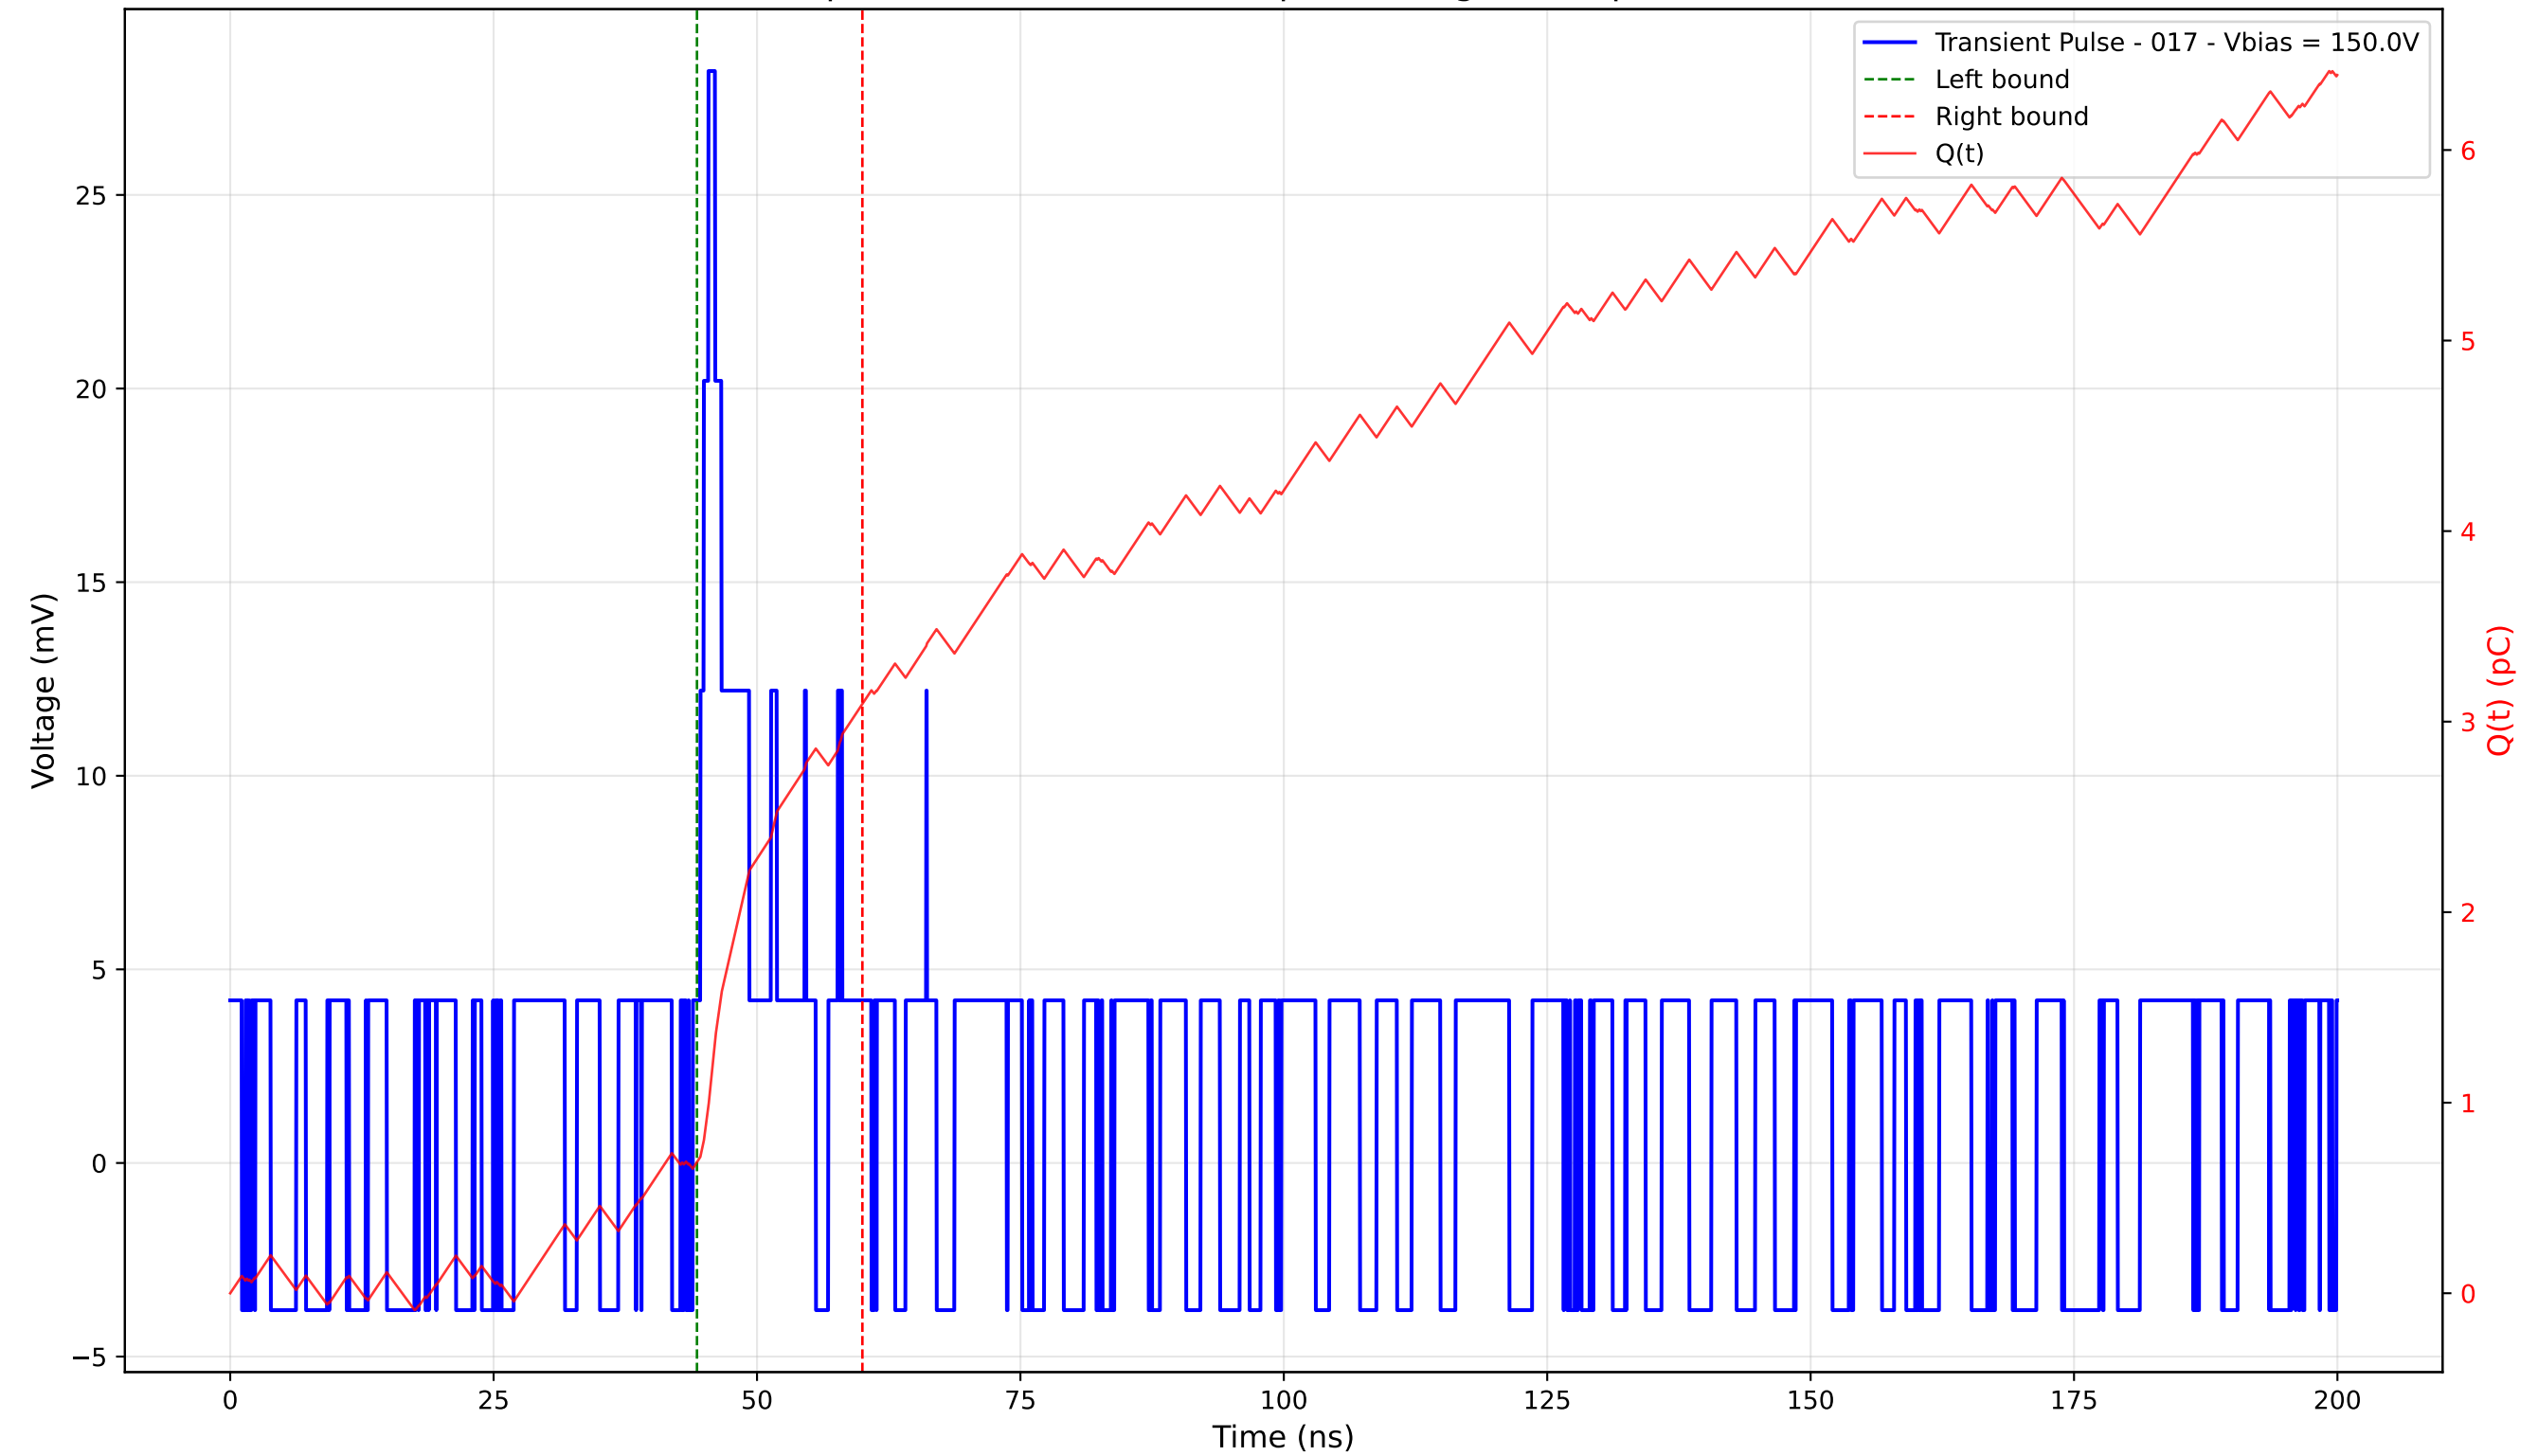


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 2.75 pC - Rise Time: 0.00 ns (N/A)

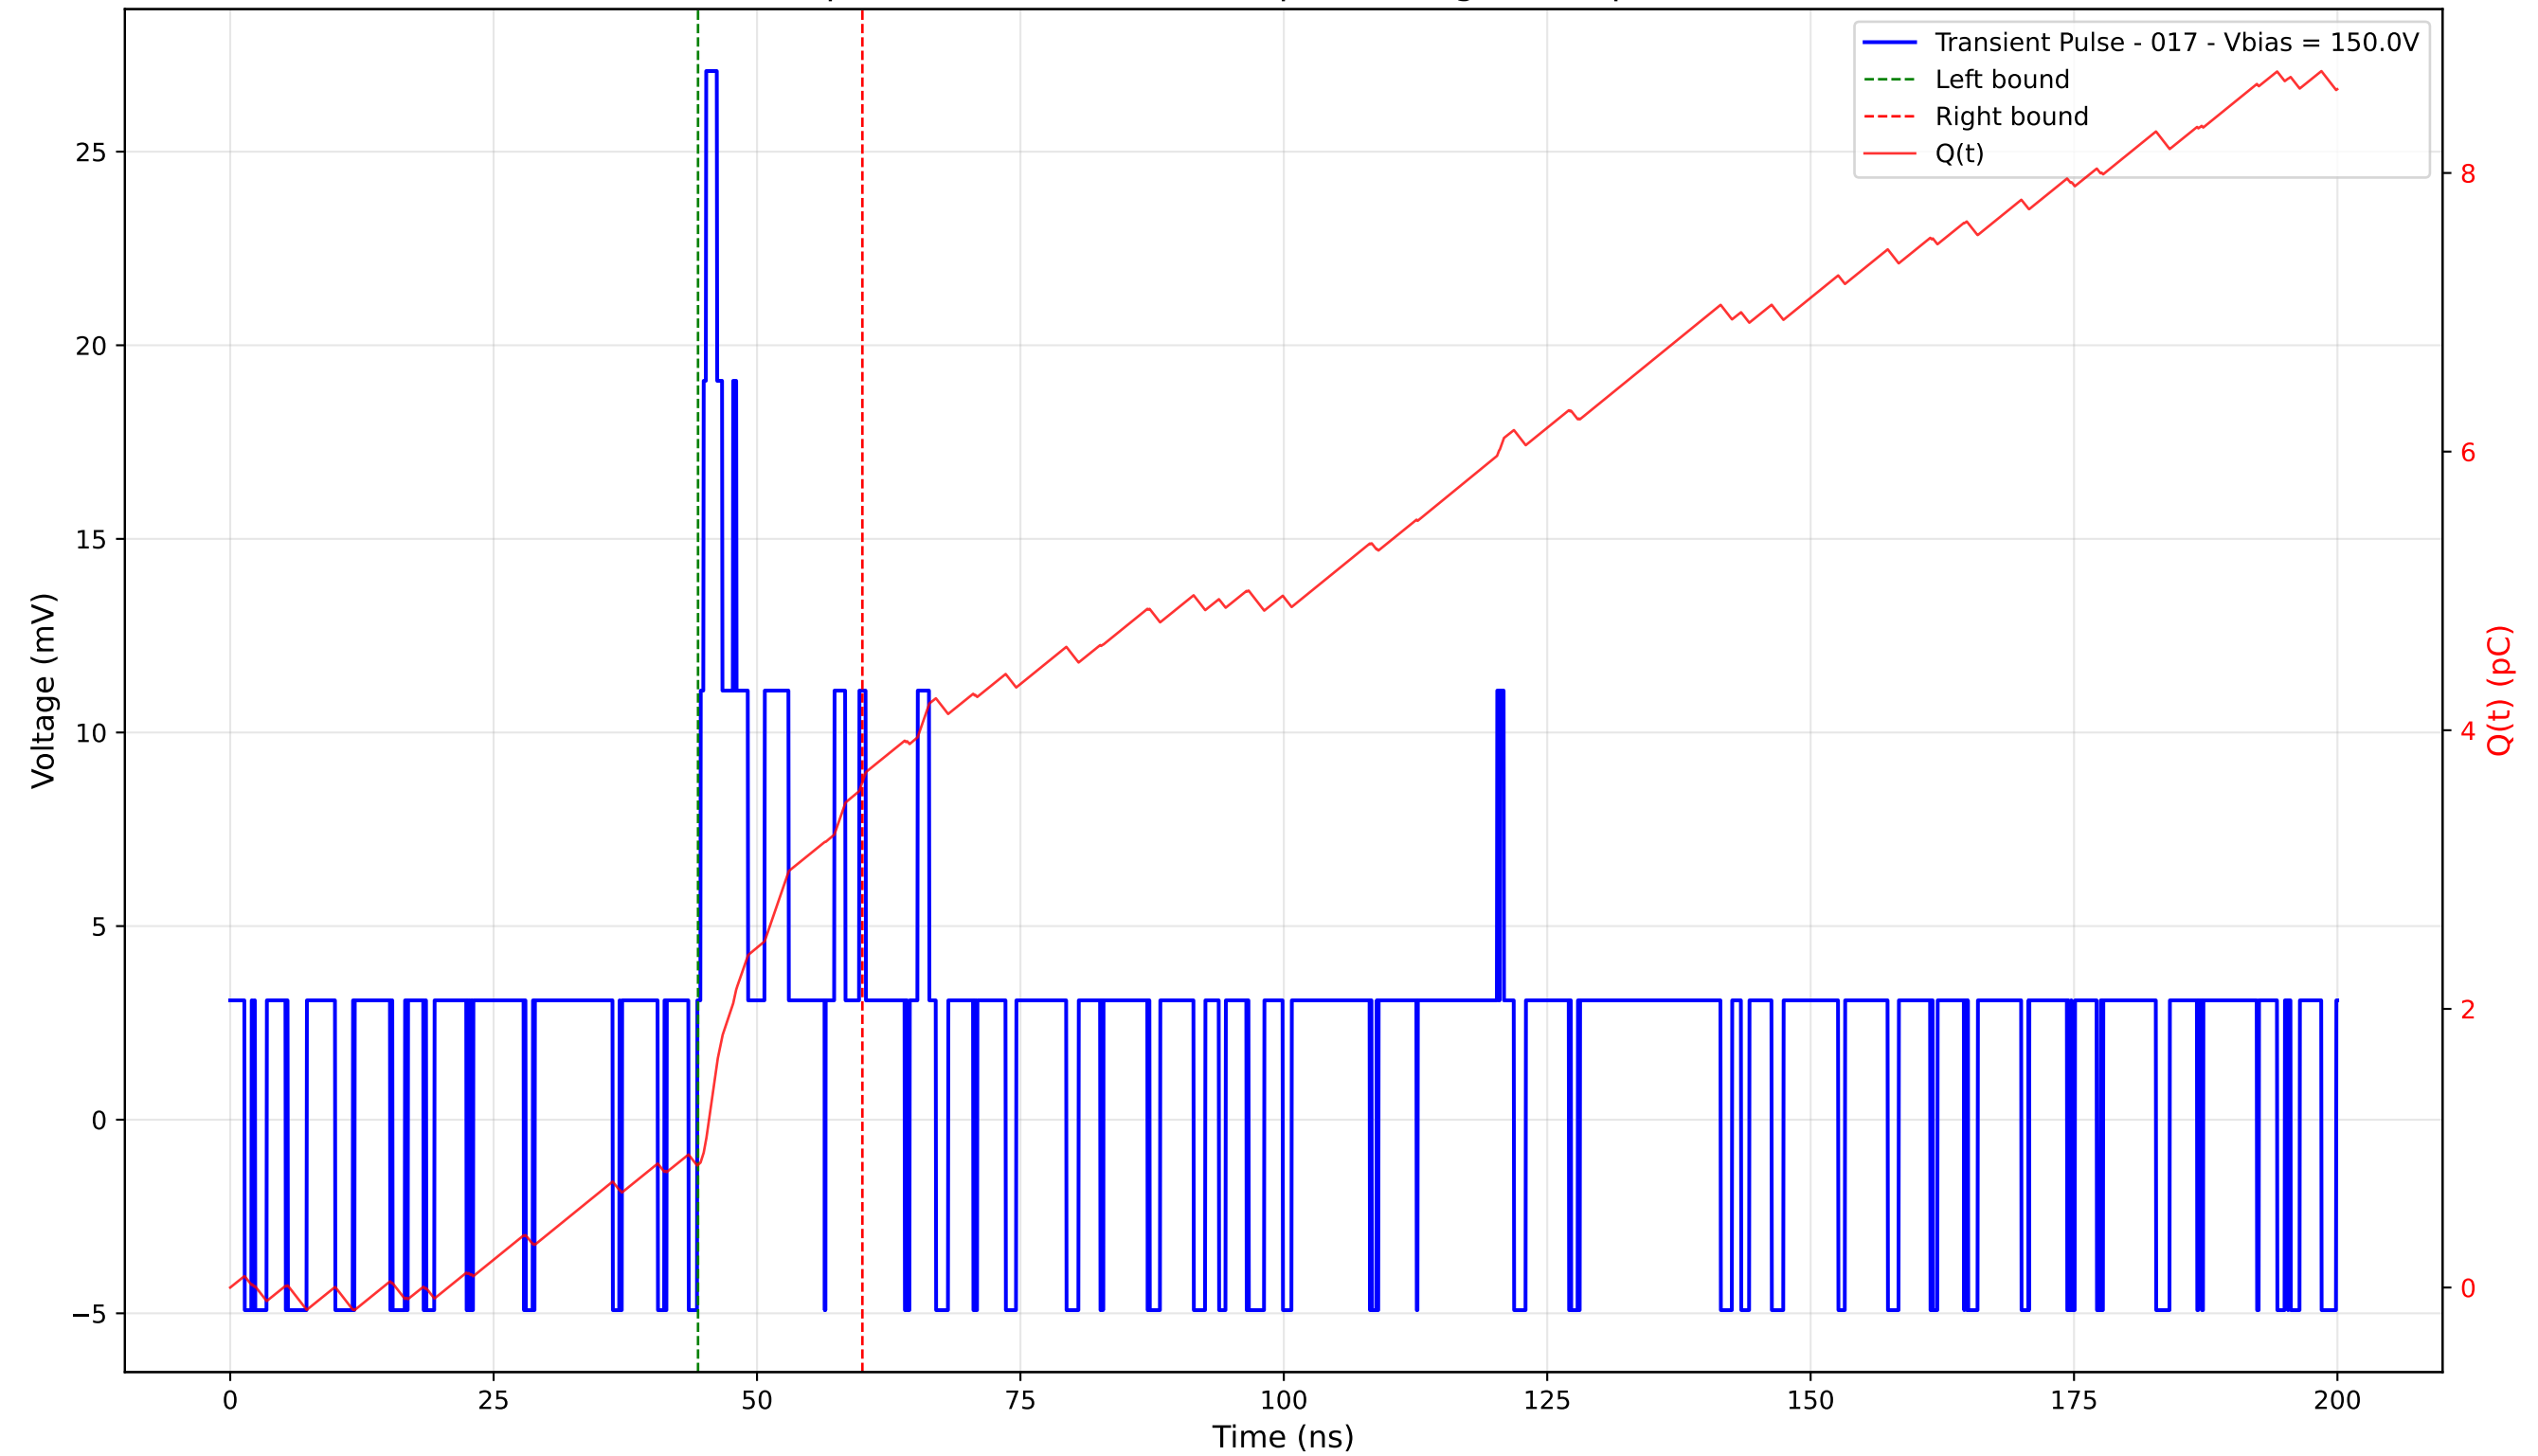


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.73 pC - Rise Time: 1.01 ns

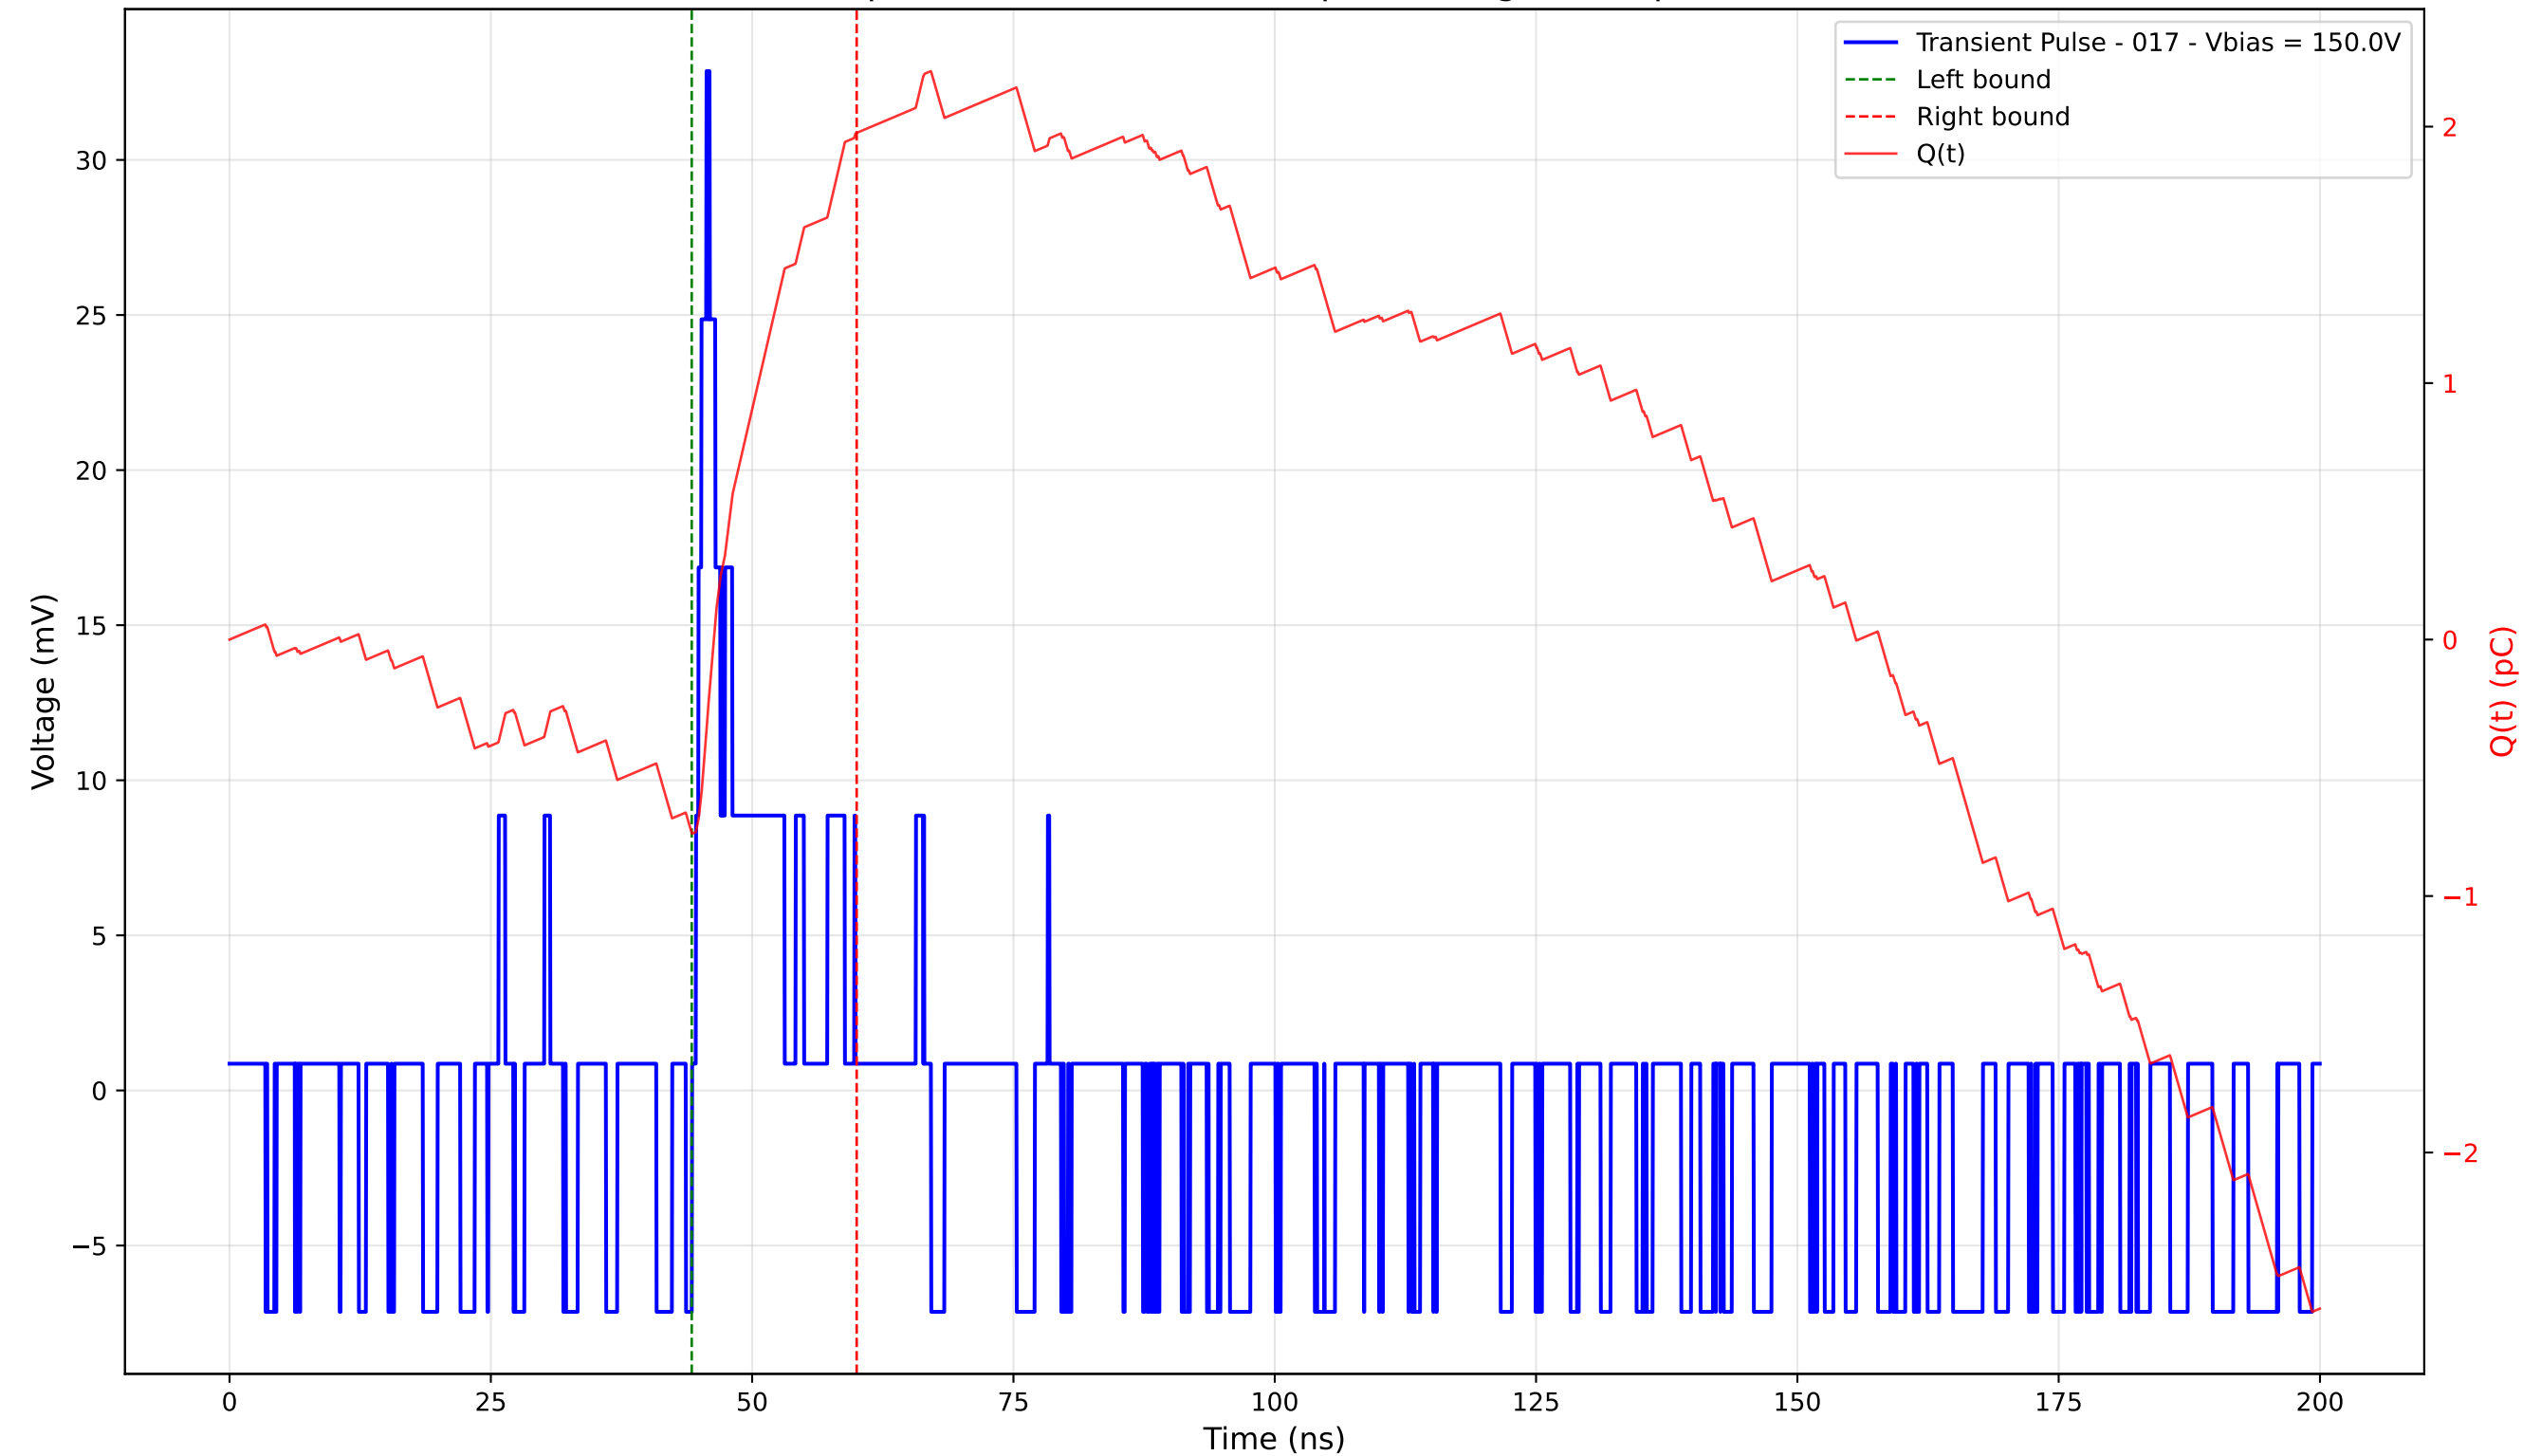


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 3.88 pC - Rise Time: 1.22 ns

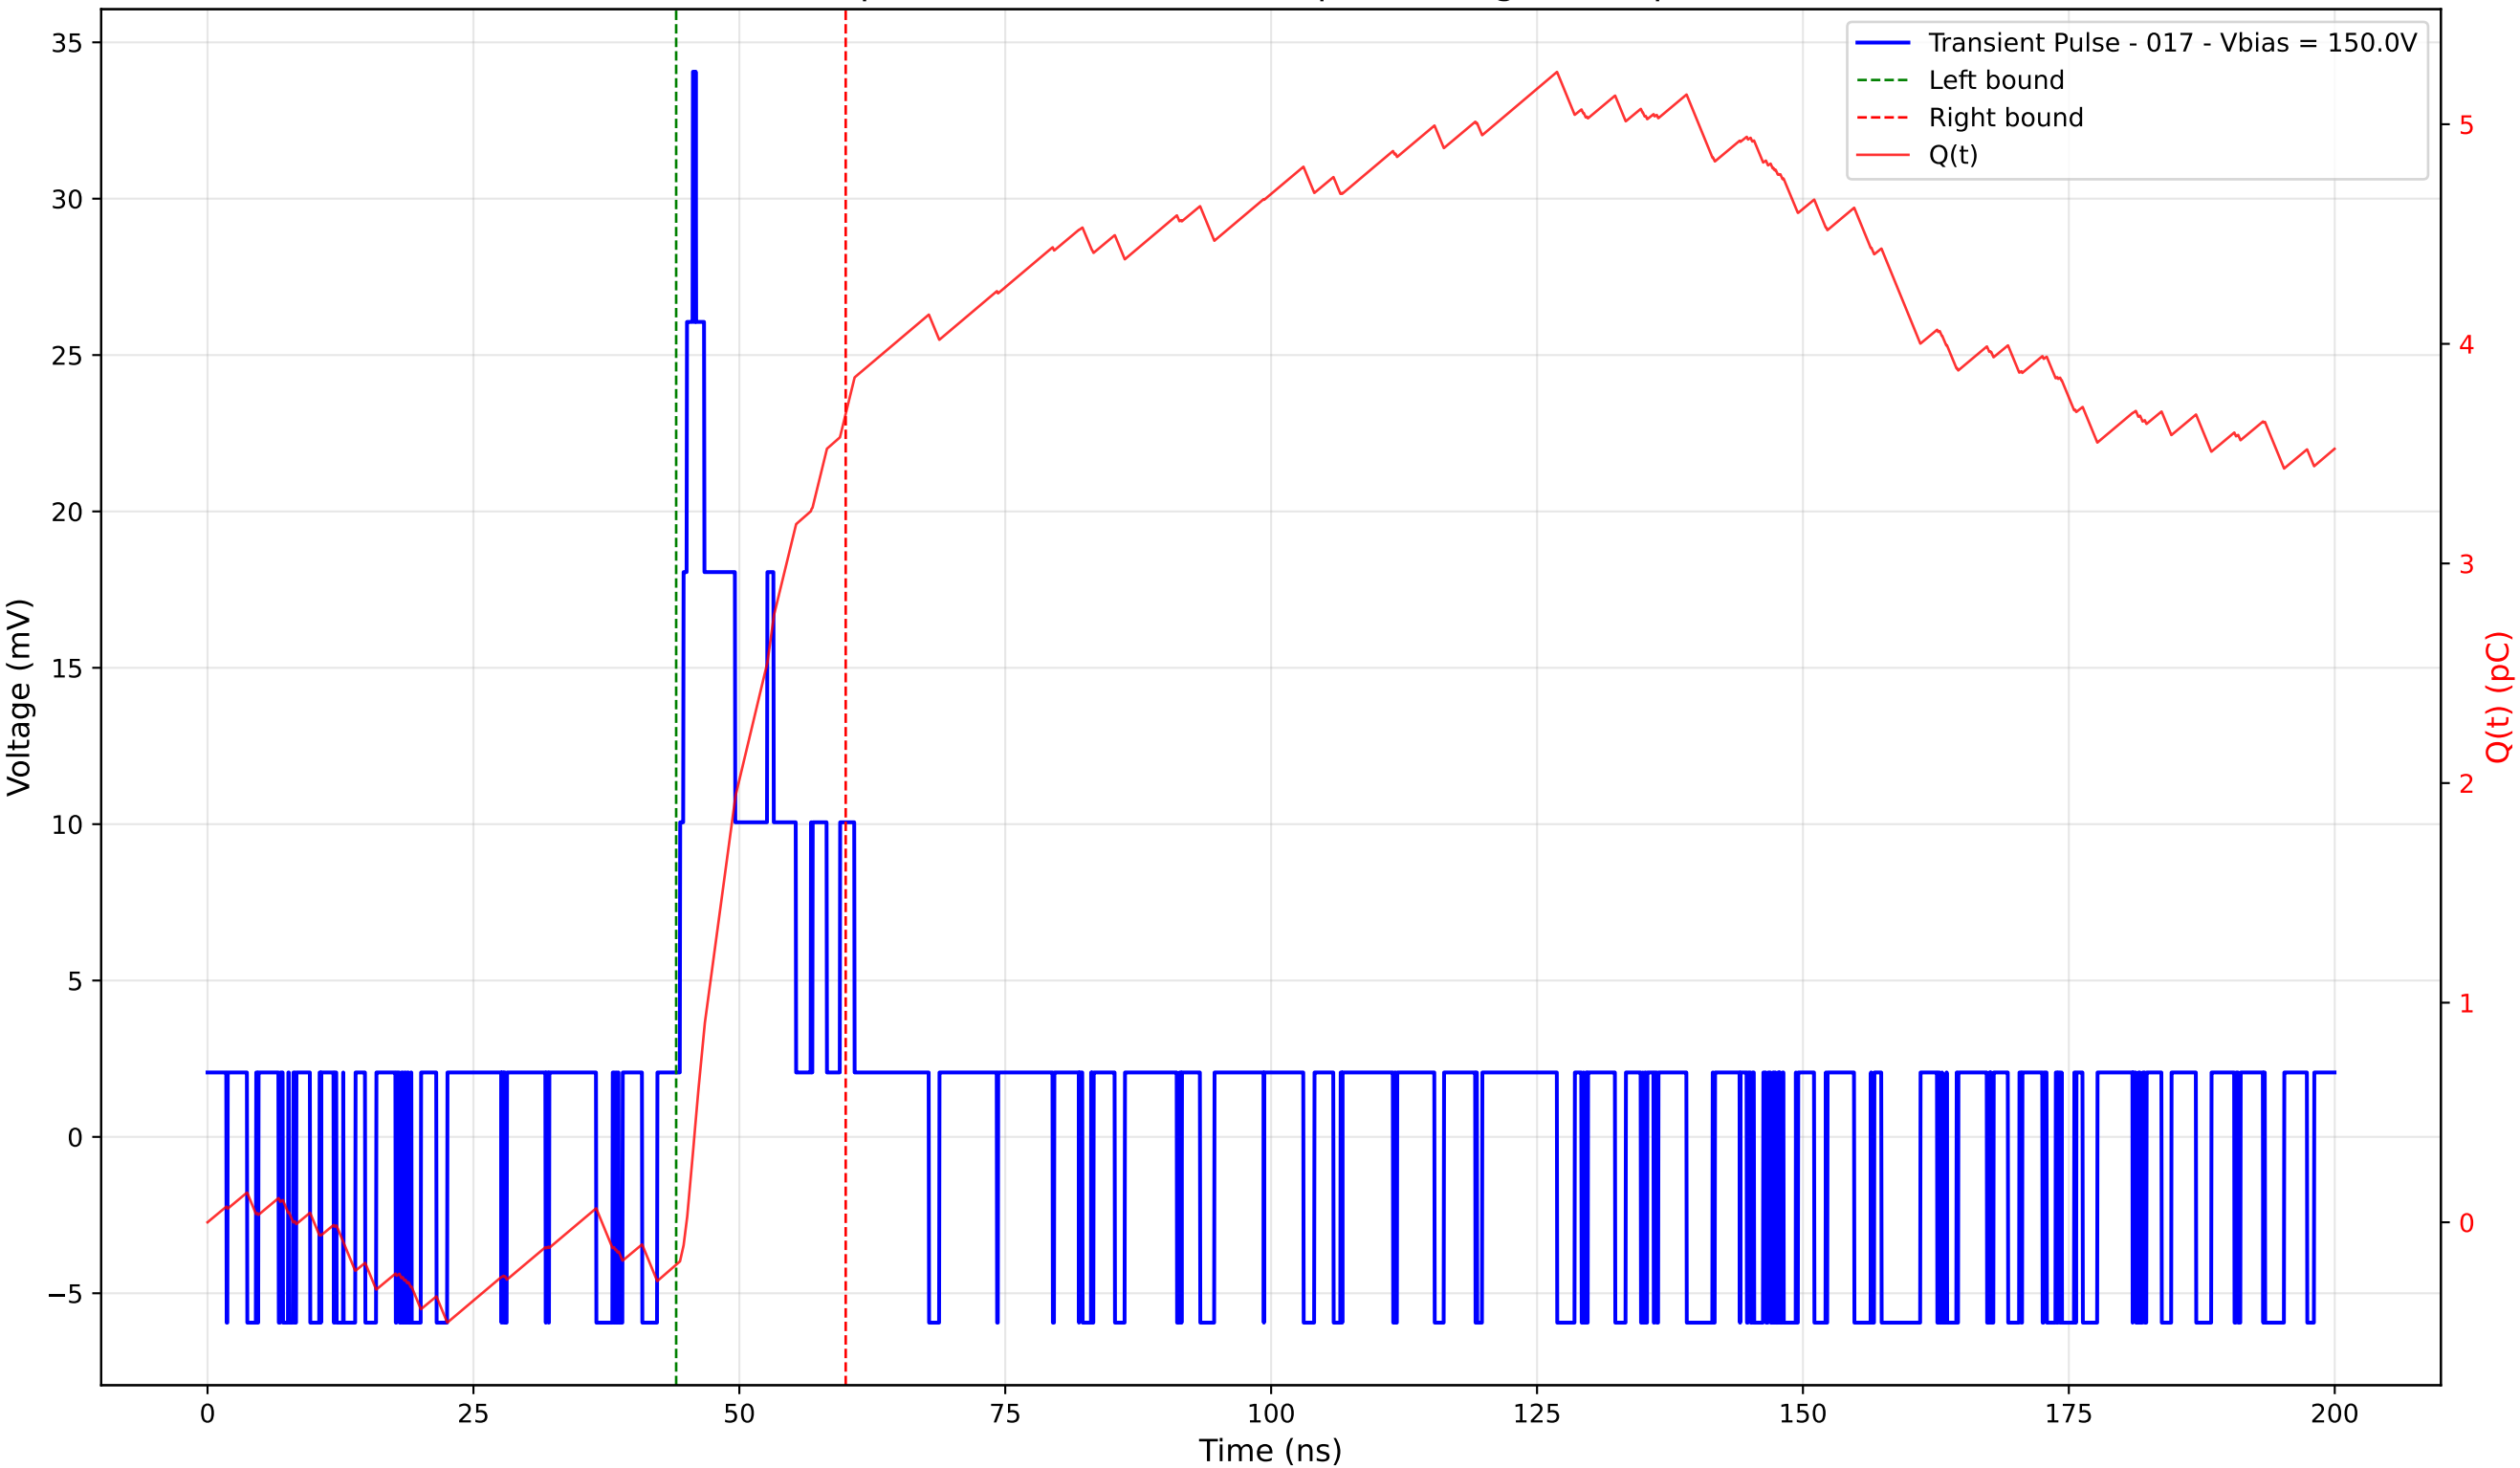


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 5.67 pC - Rise Time: 0.95 ns

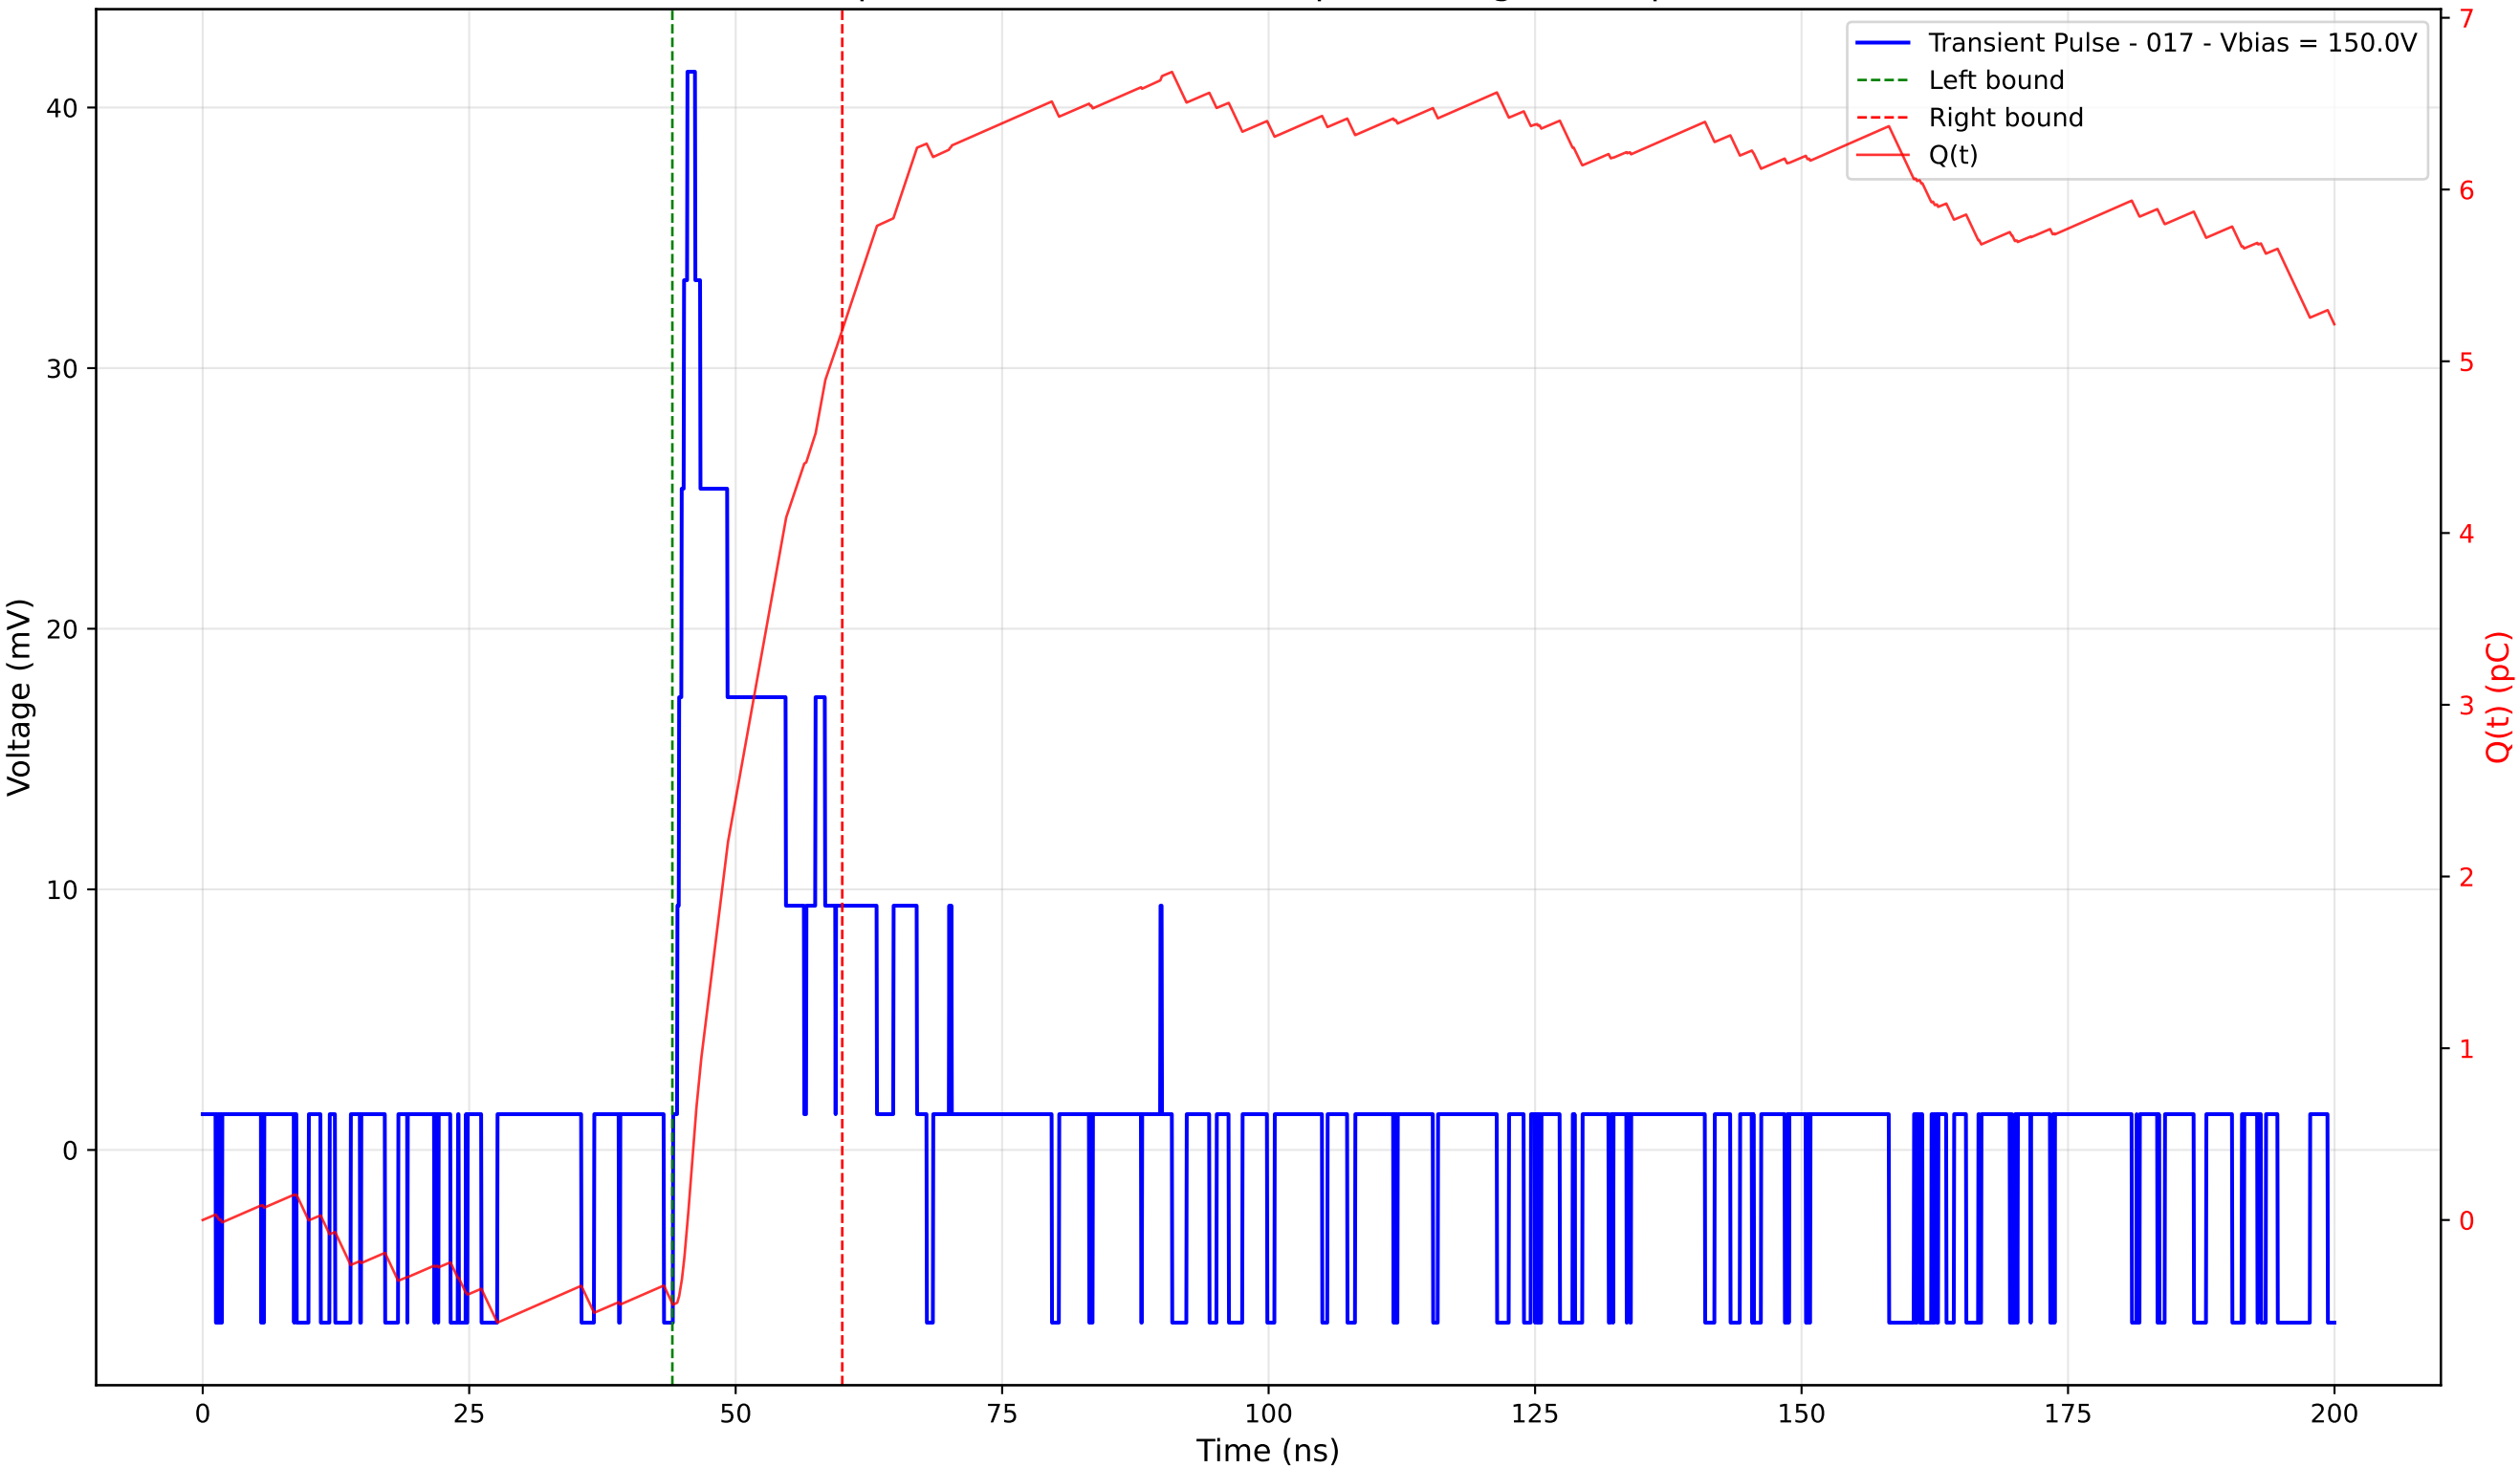


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 6.45 pC - Rise Time: 0.84 ns

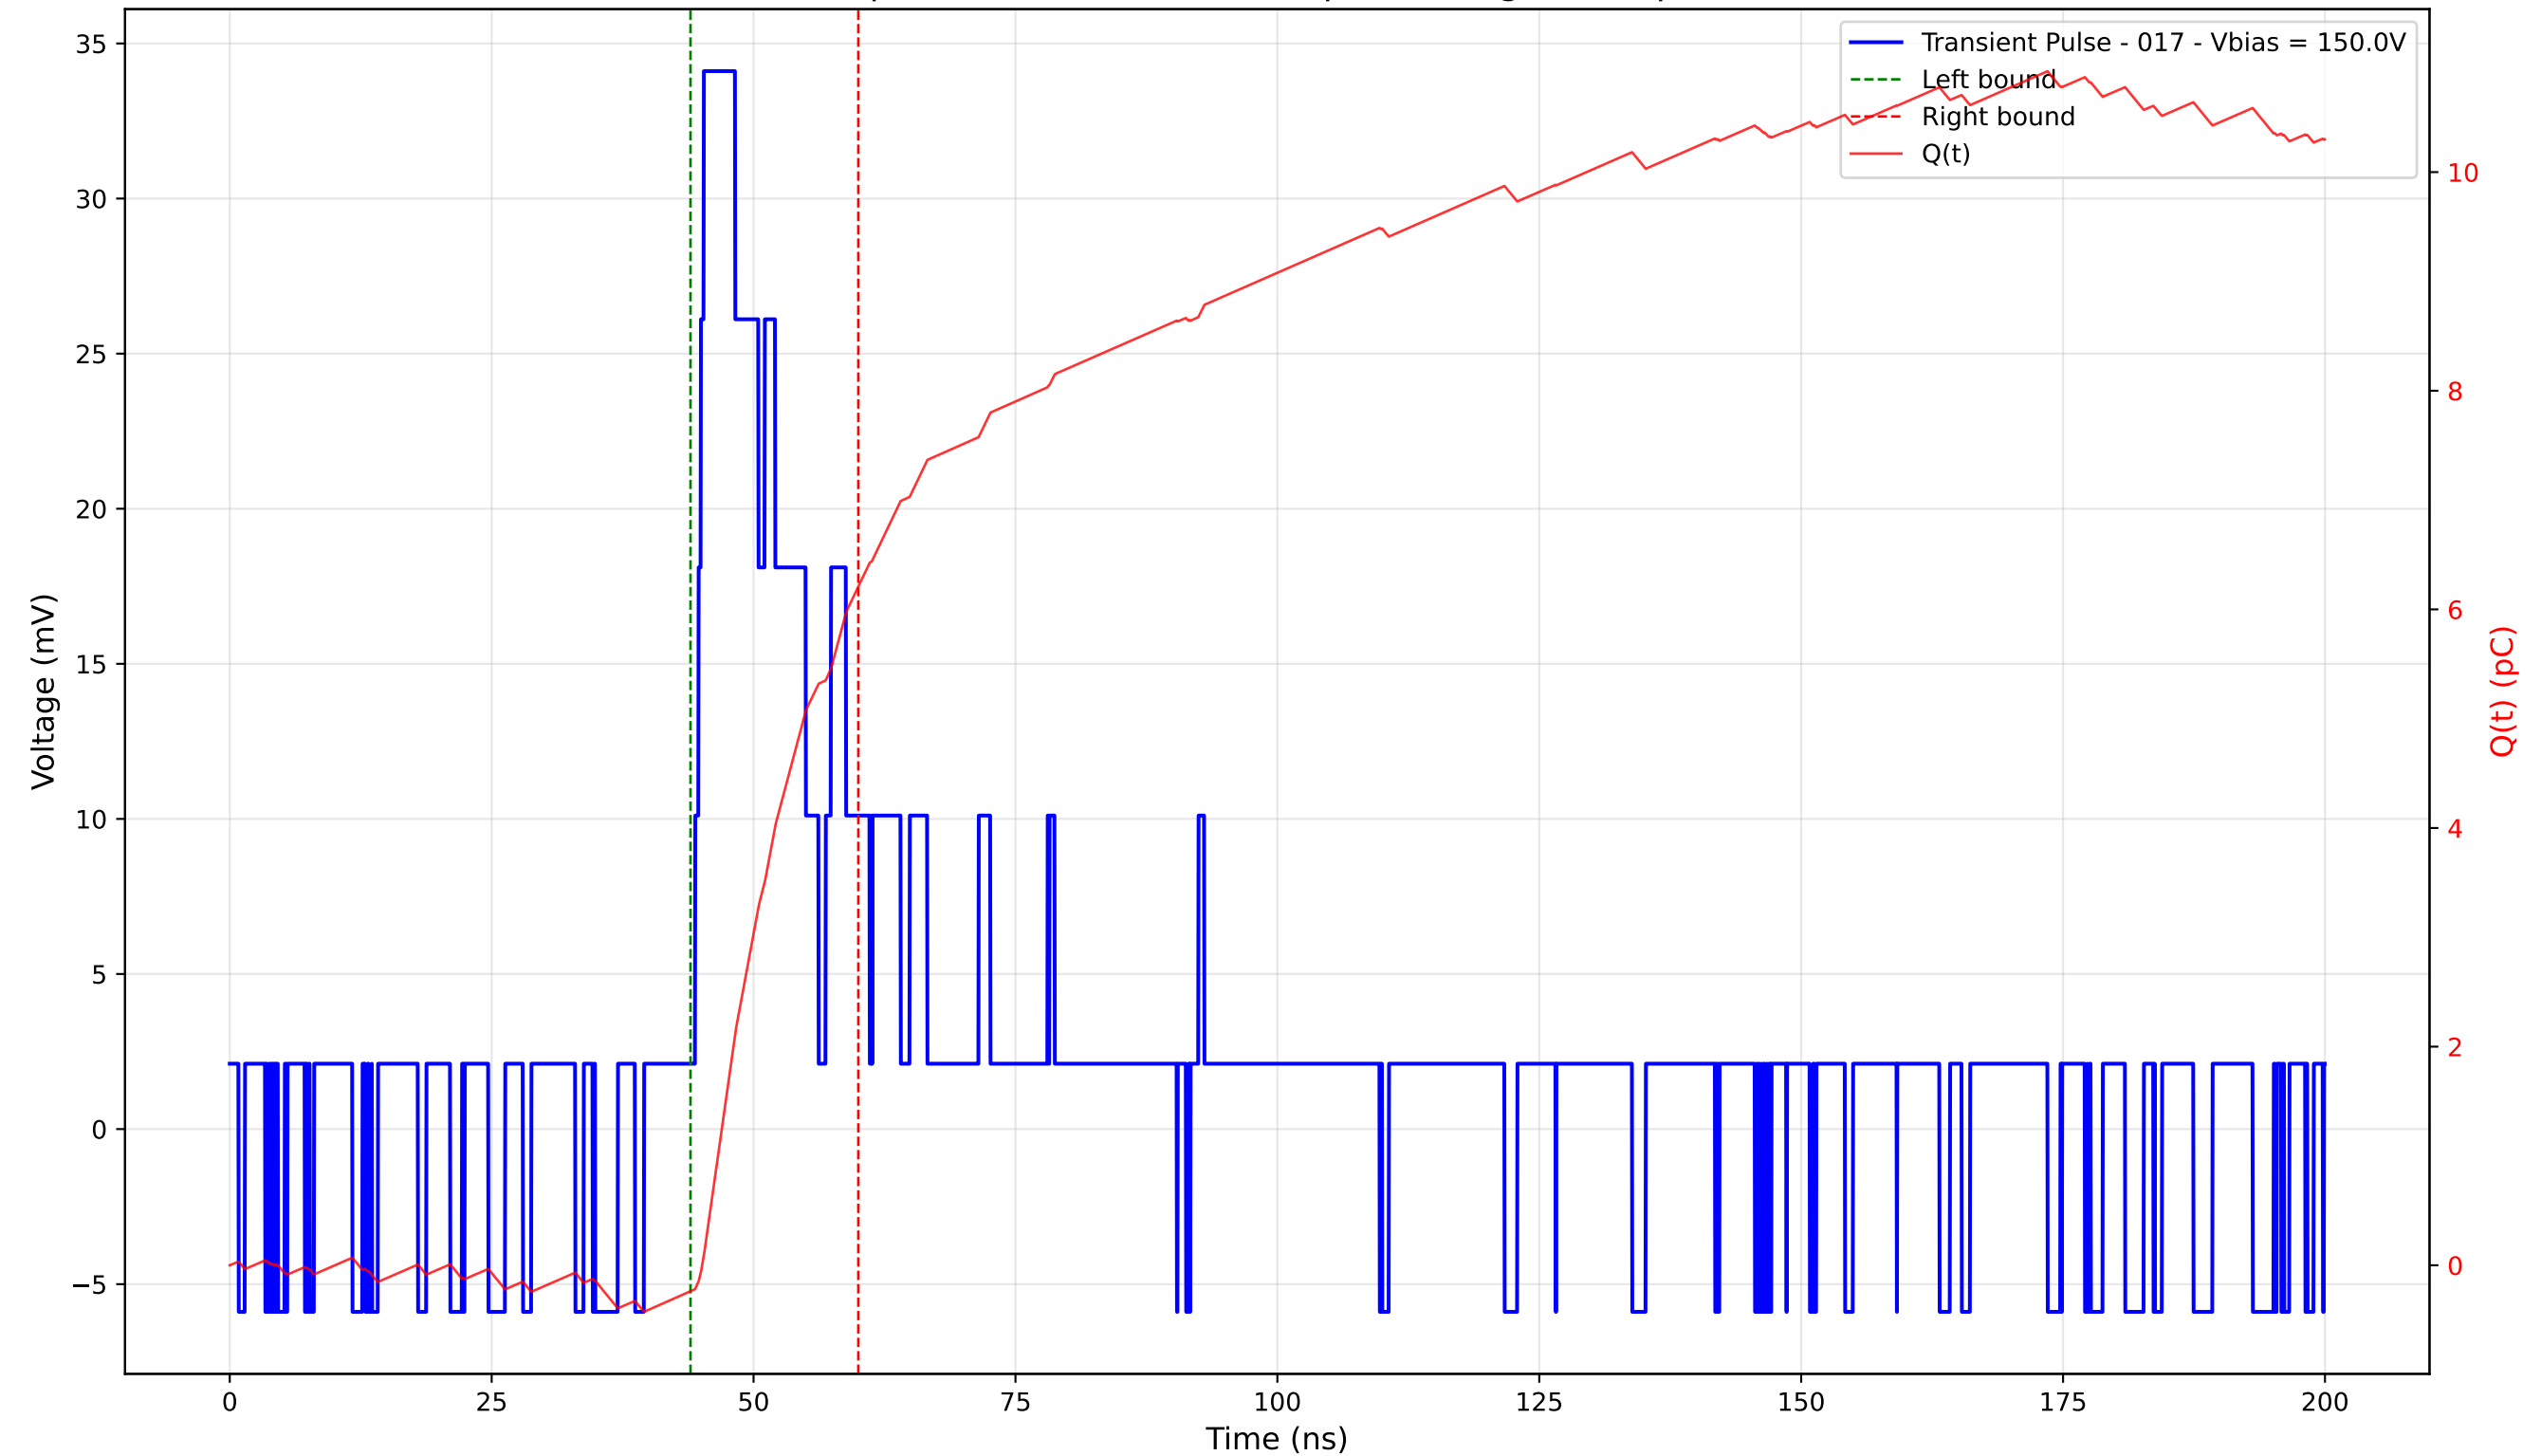


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 5.00 pC - Rise Time: 0.94 ns

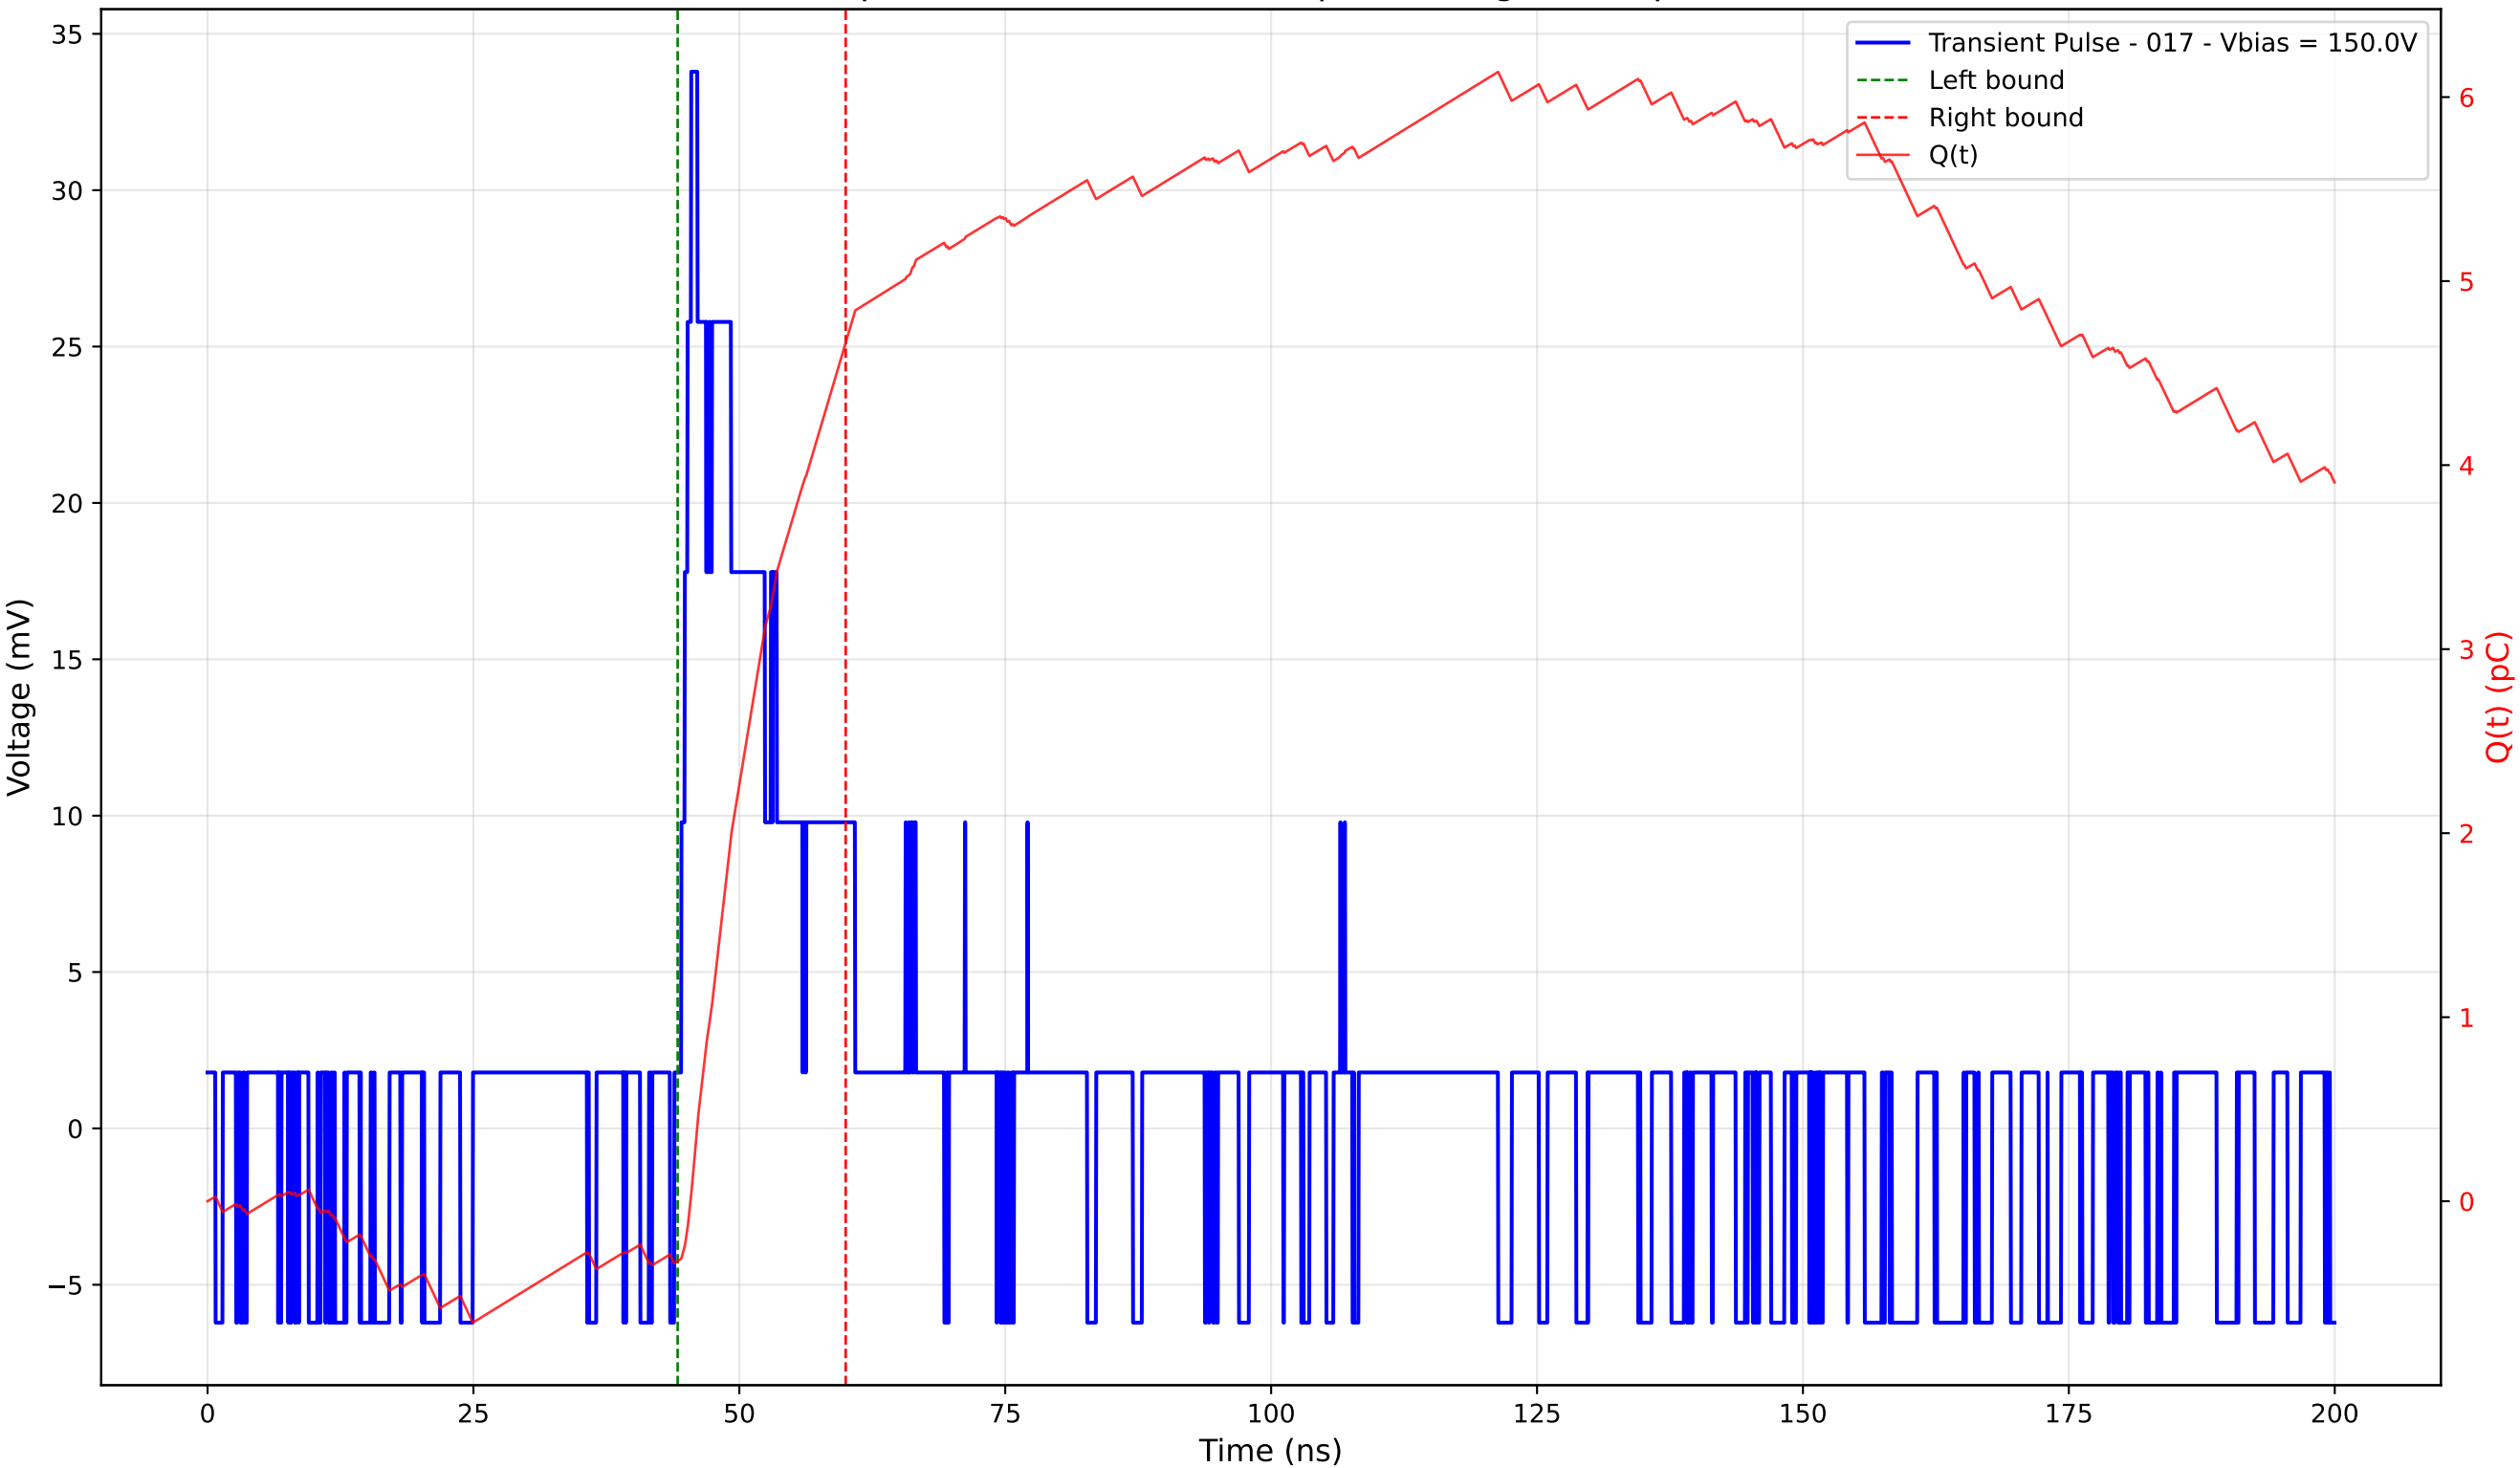


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 3.98 pC - Rise Time: 3.86 ns

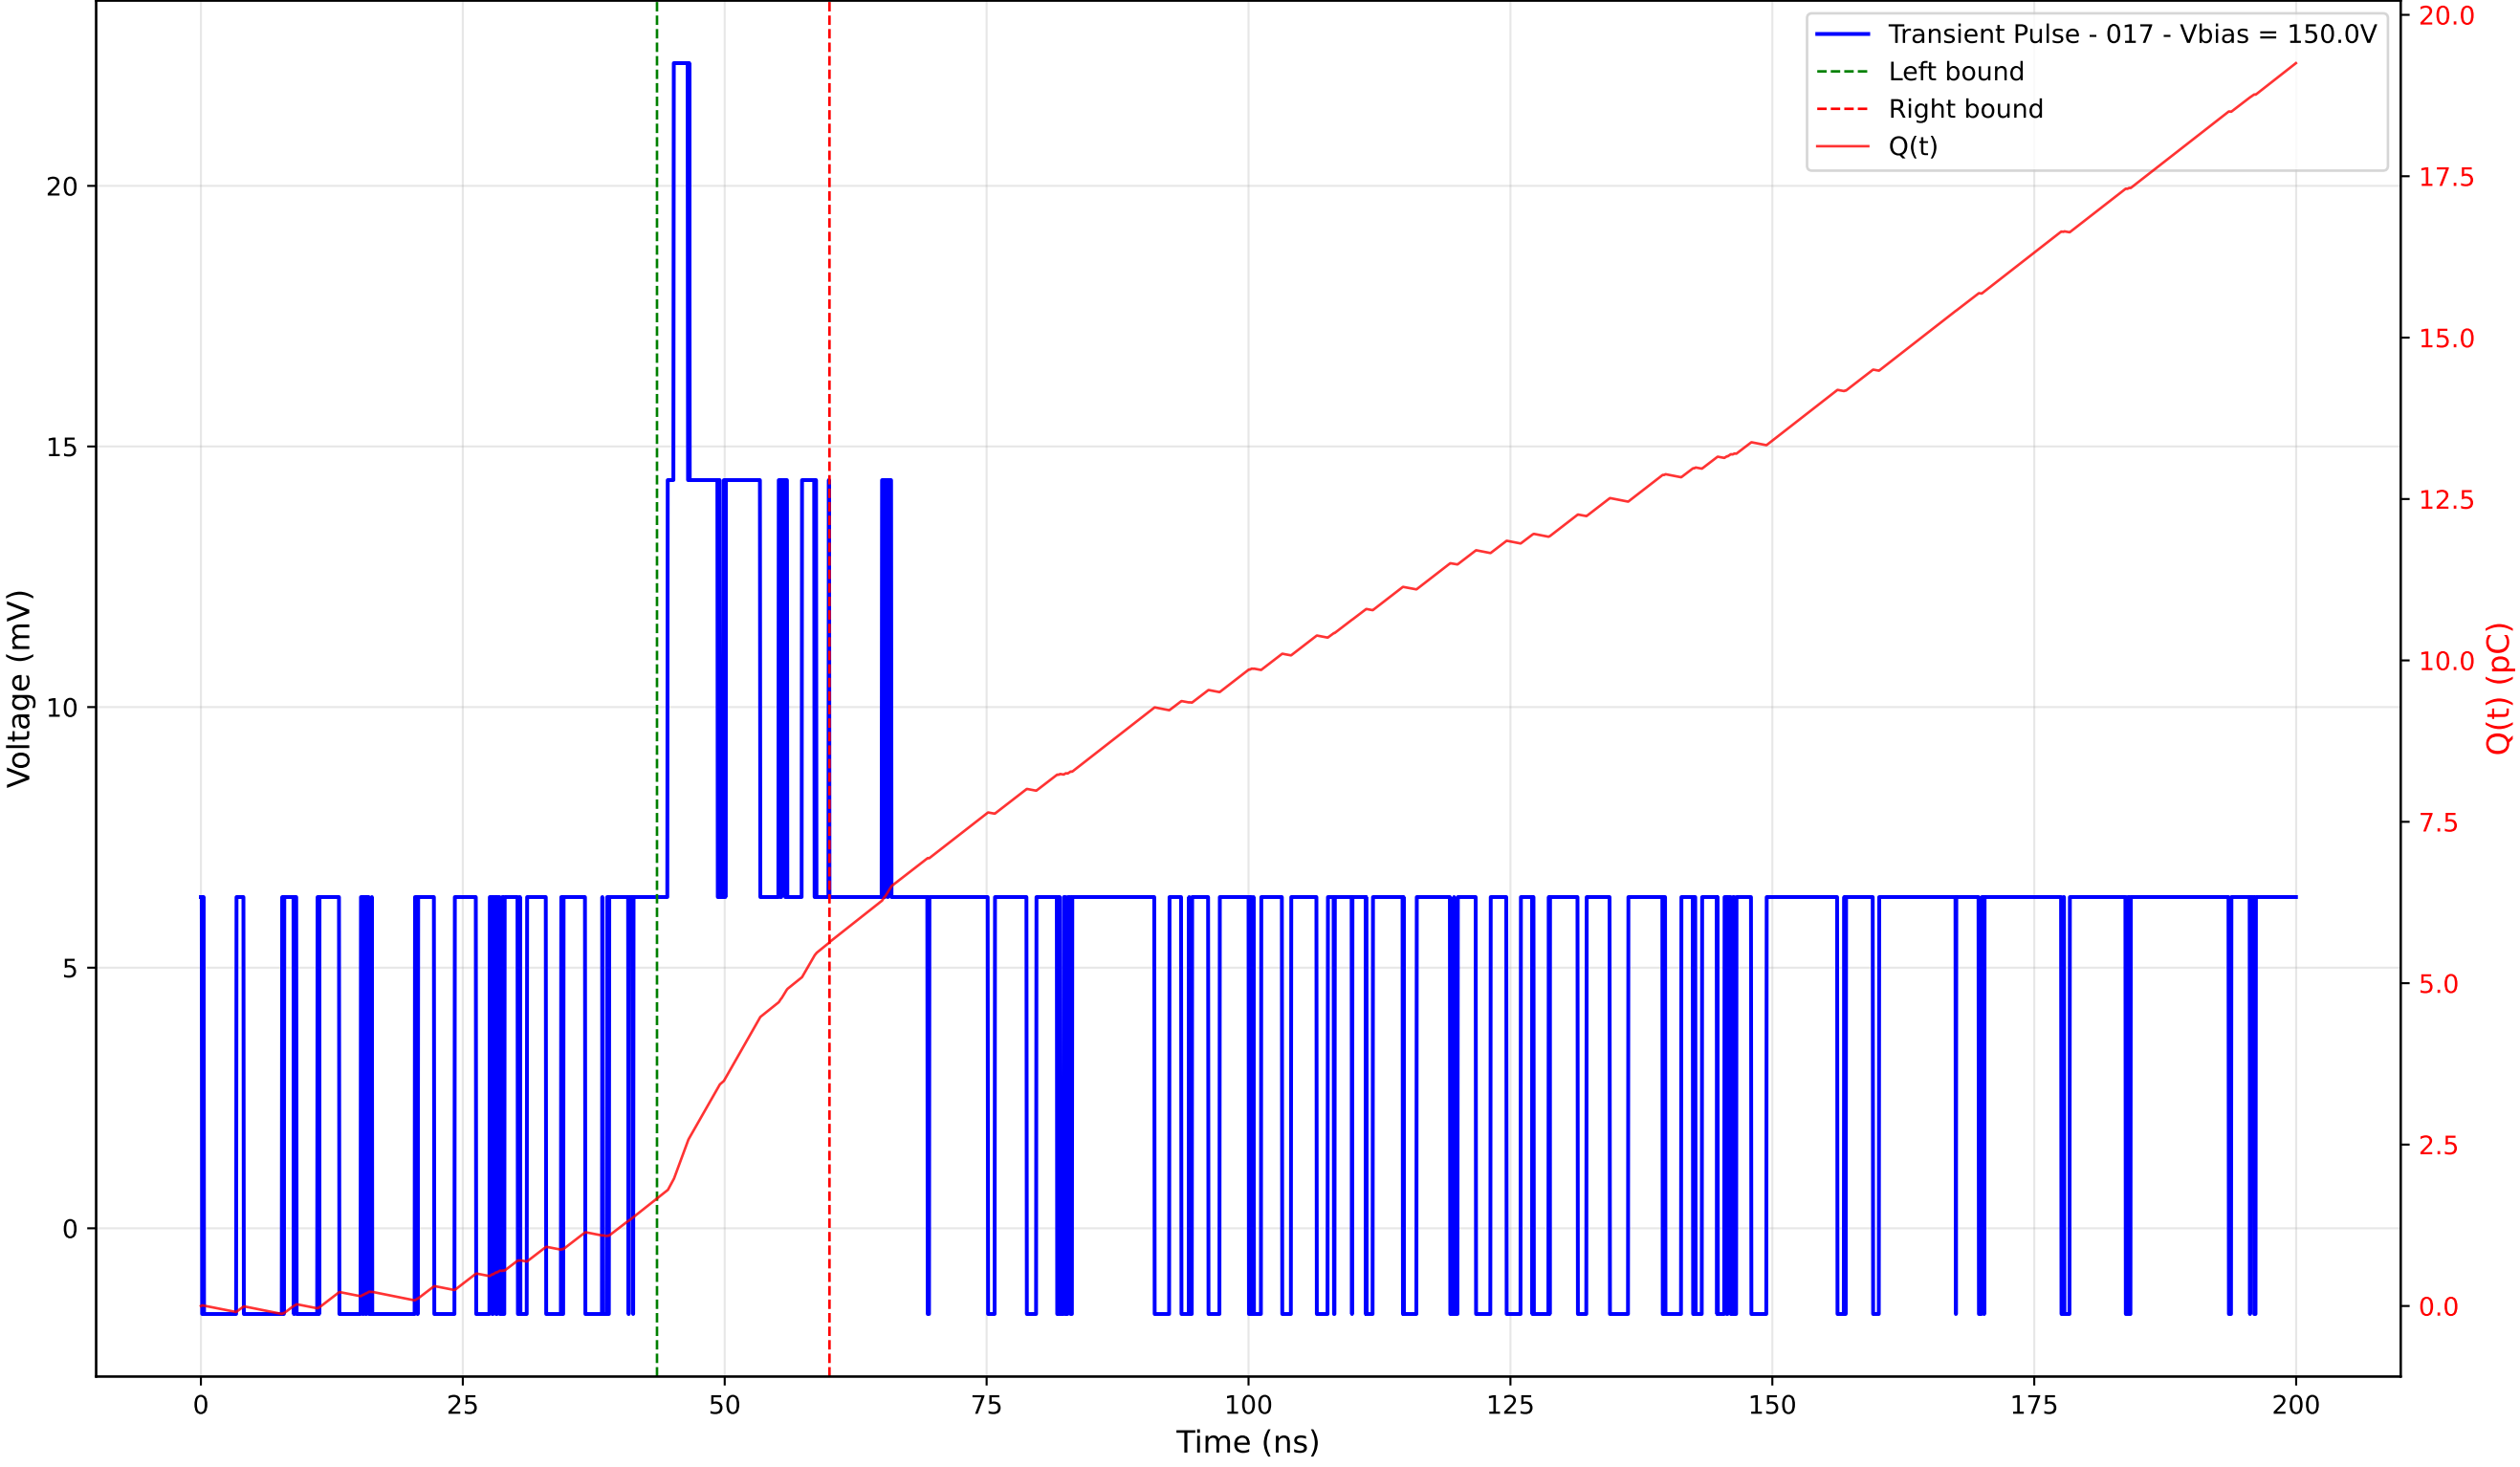


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 2.01 pC - Rise Time: 0.00 ns (N/A)

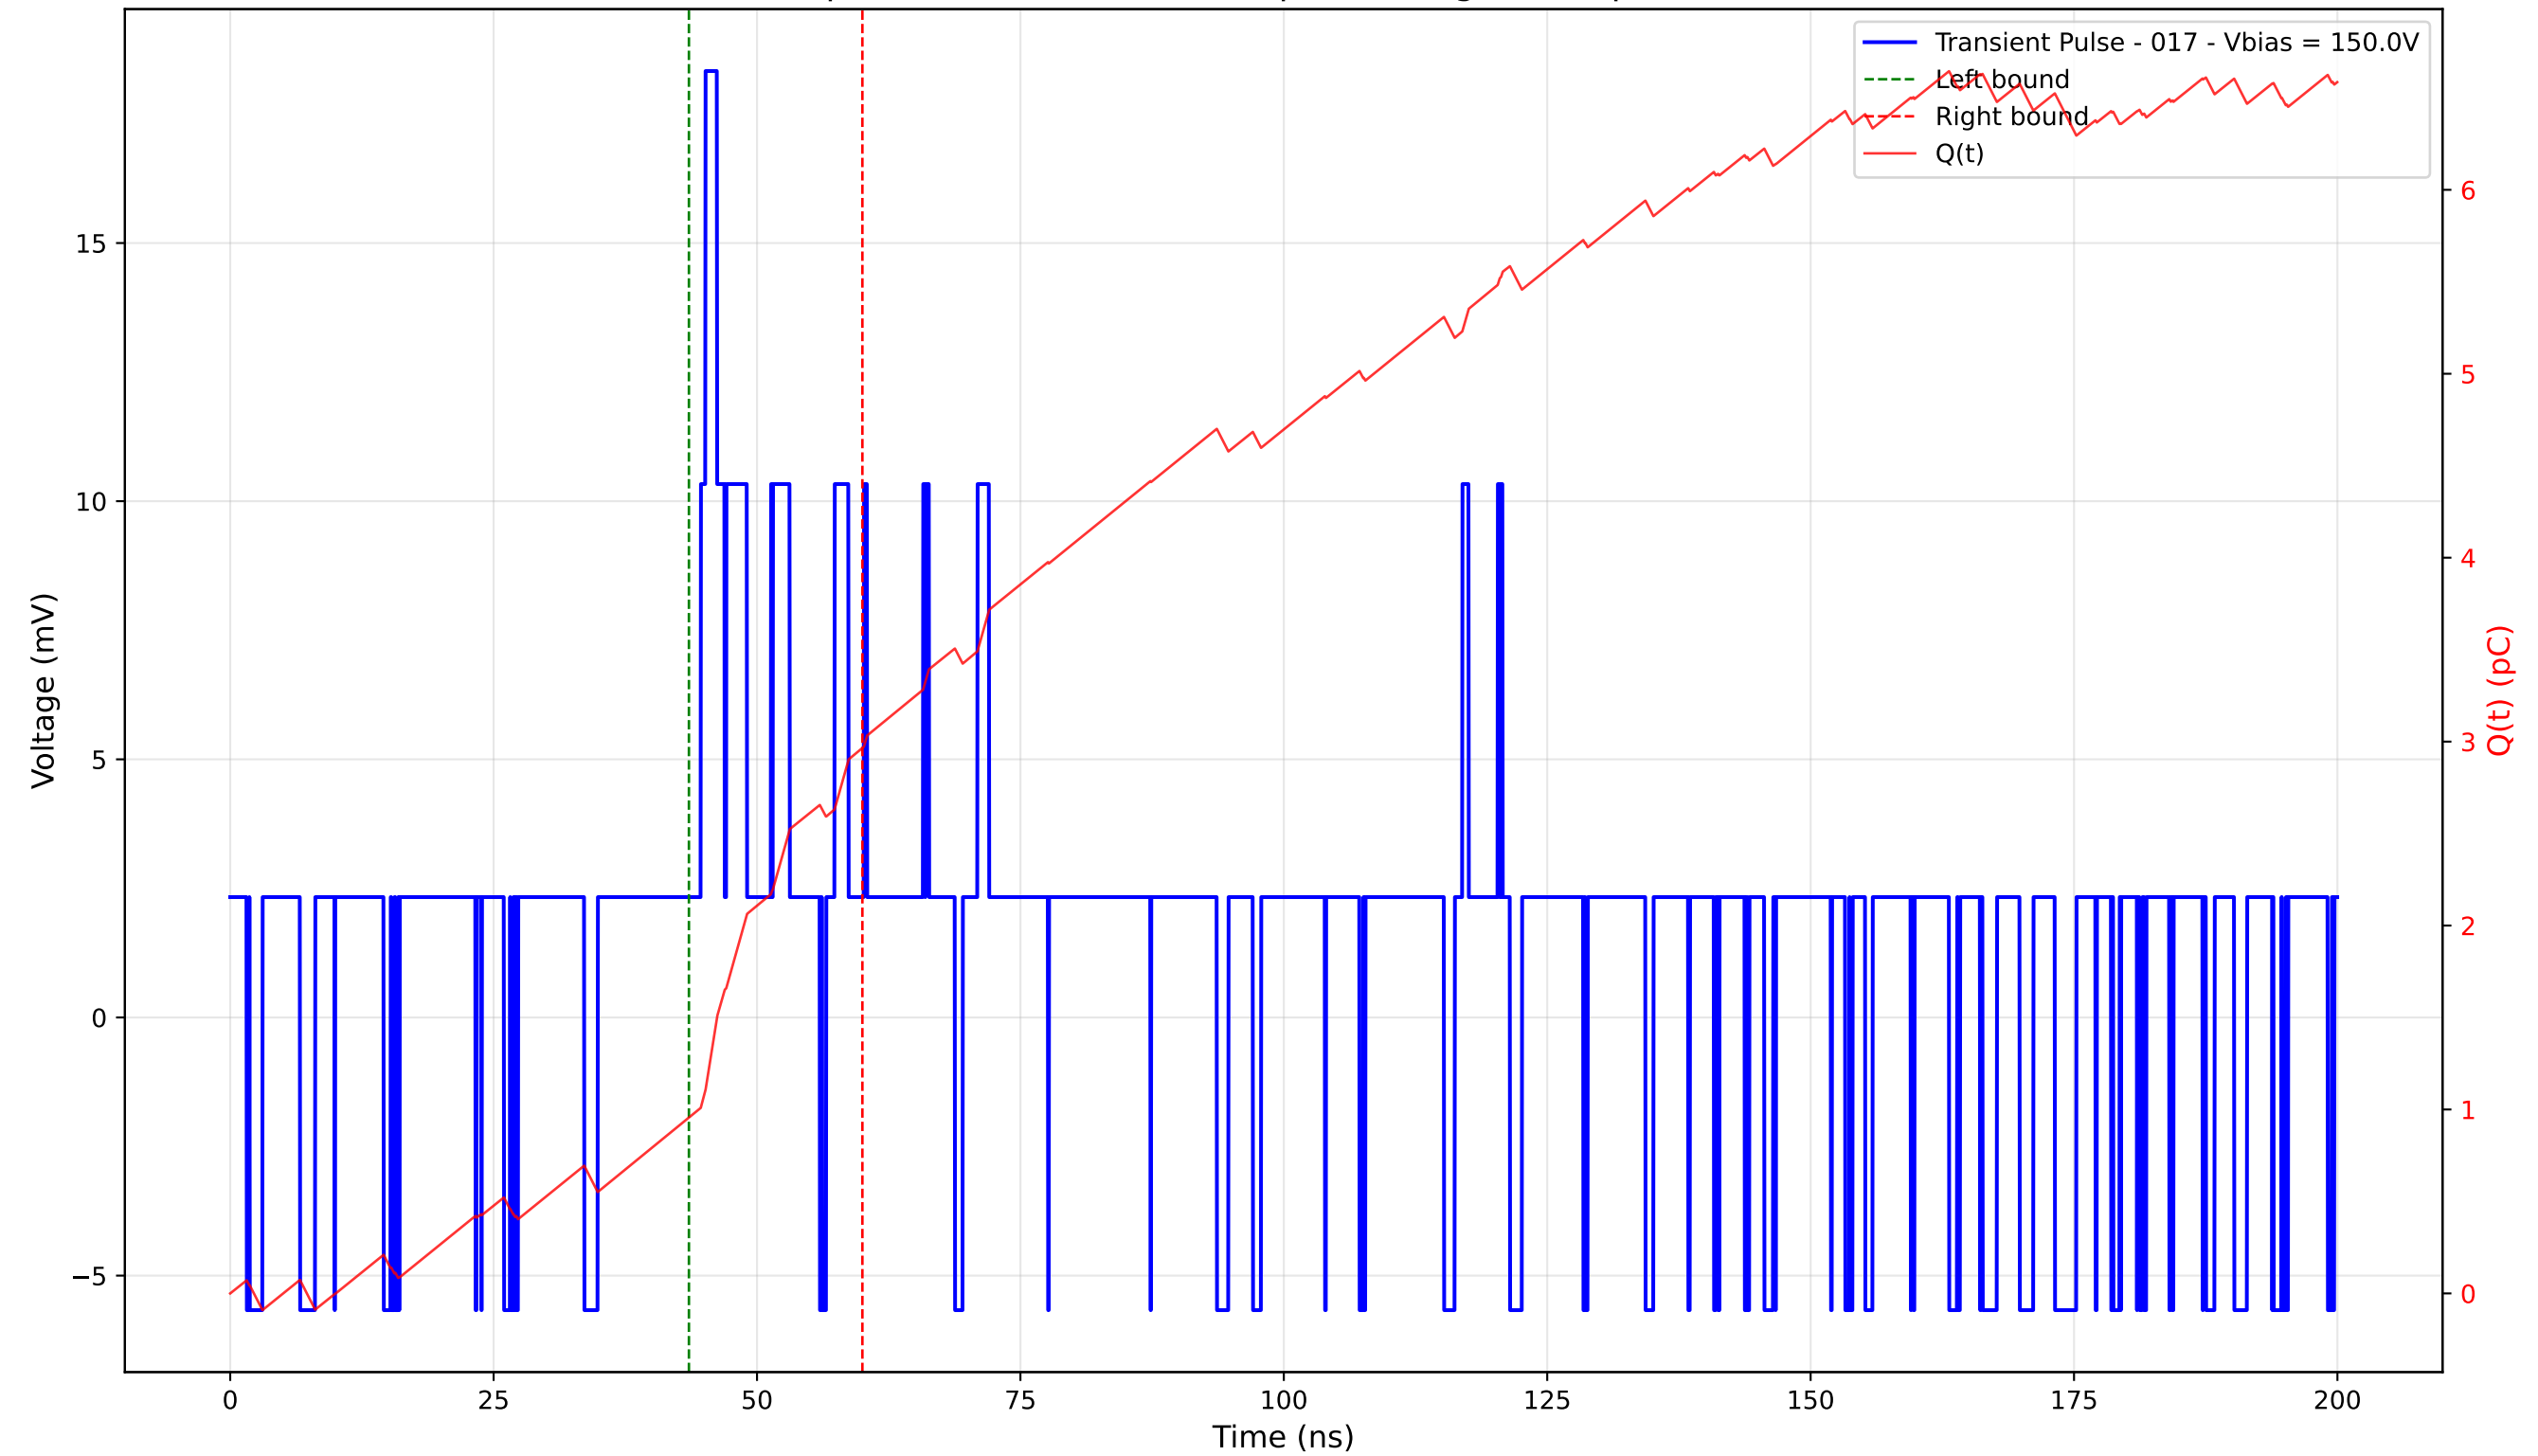


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 2.88 pC - Rise Time: 0.73 ns

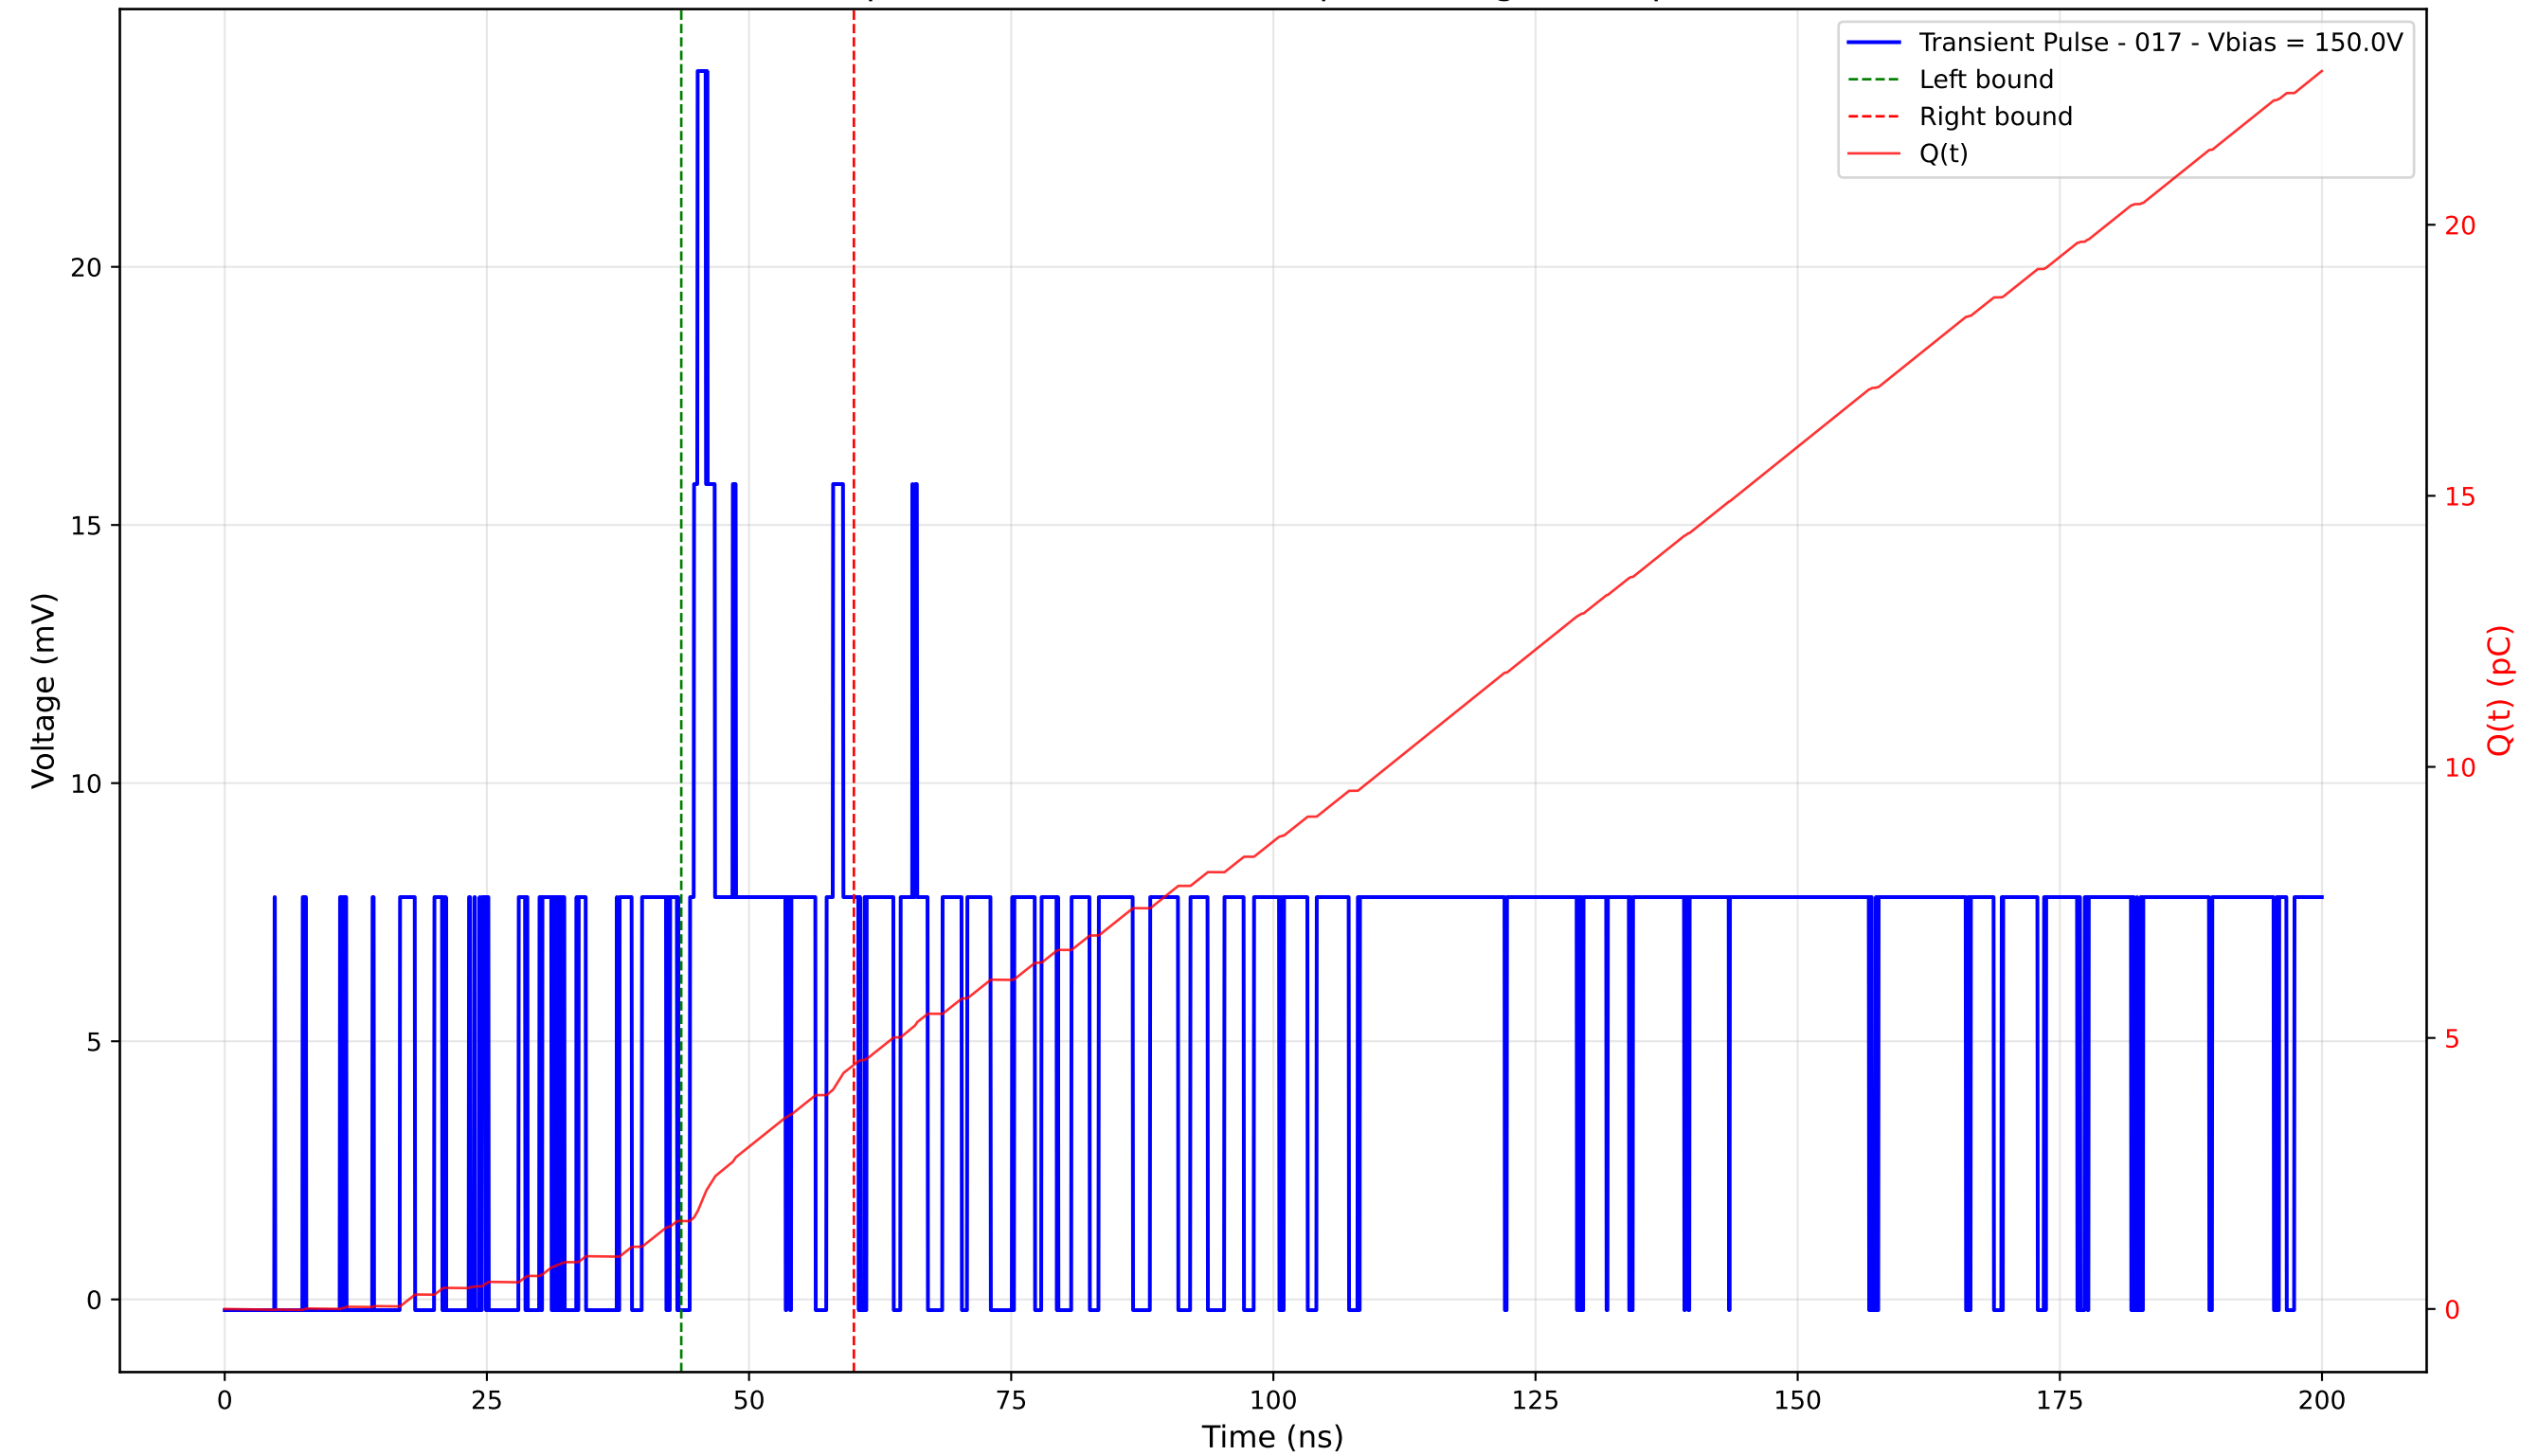


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 3.25 pC - Rise Time: 0.74 ns

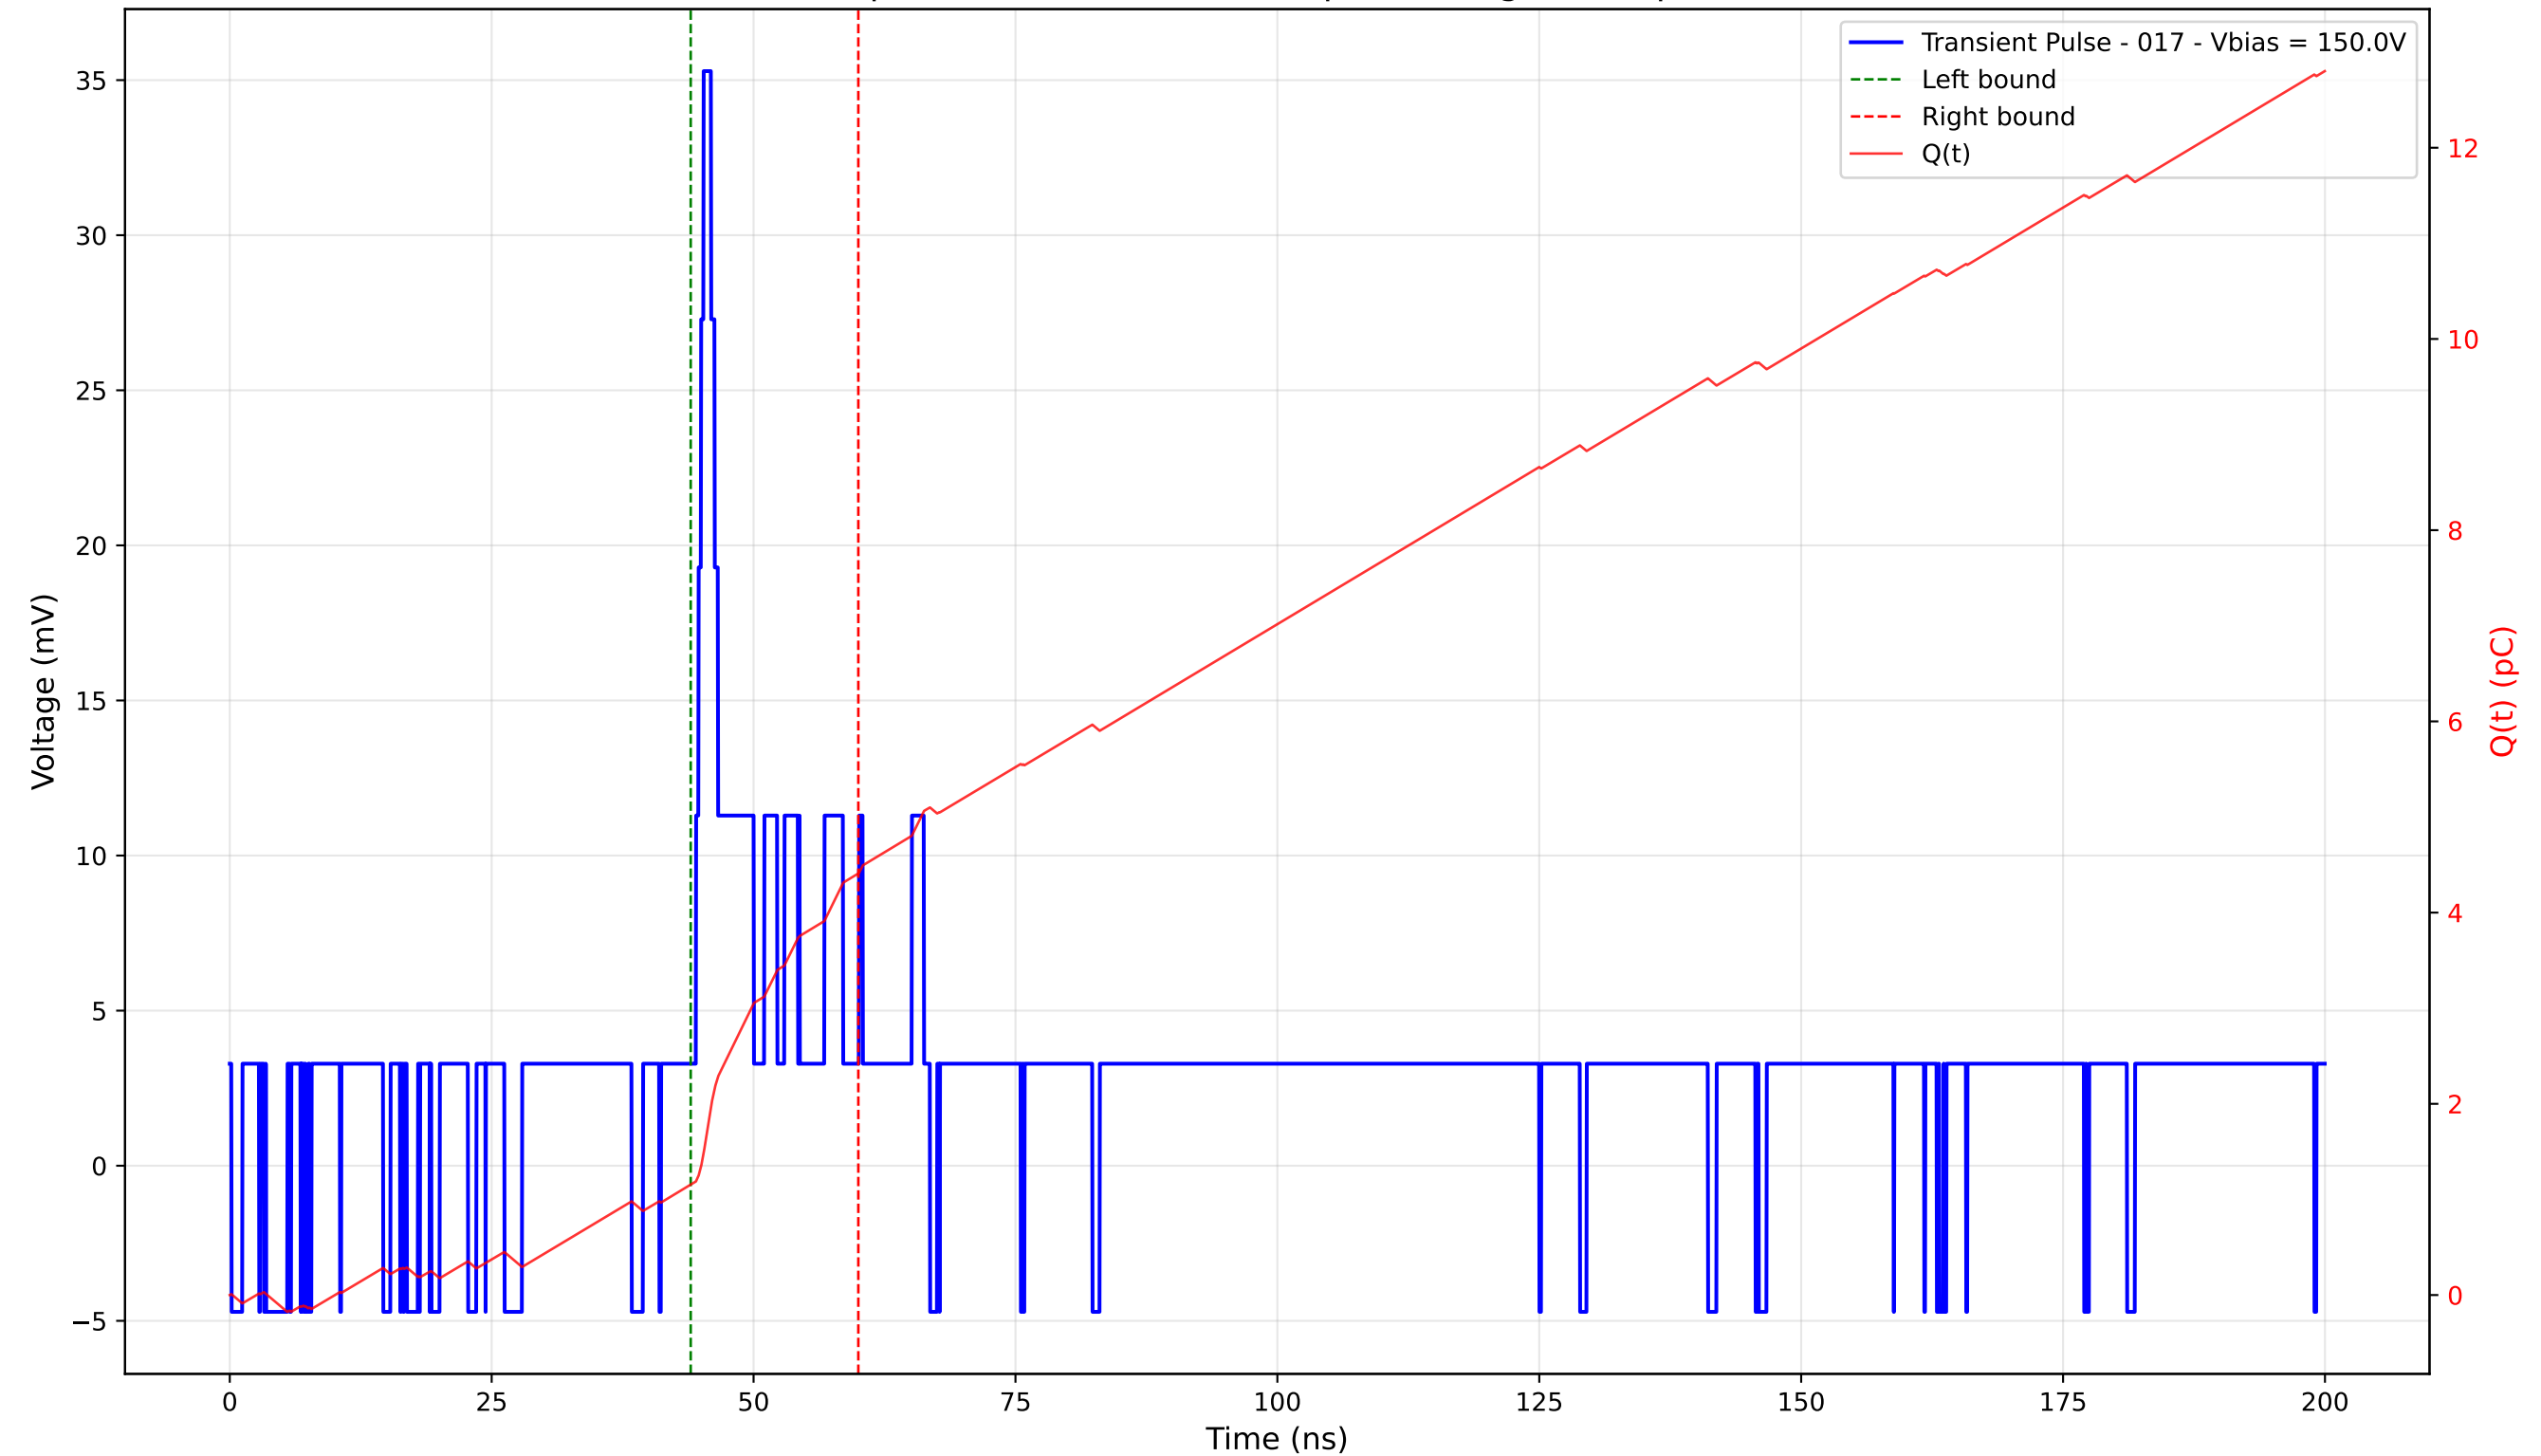


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 4.24 pC - Rise Time: 1.01 ns

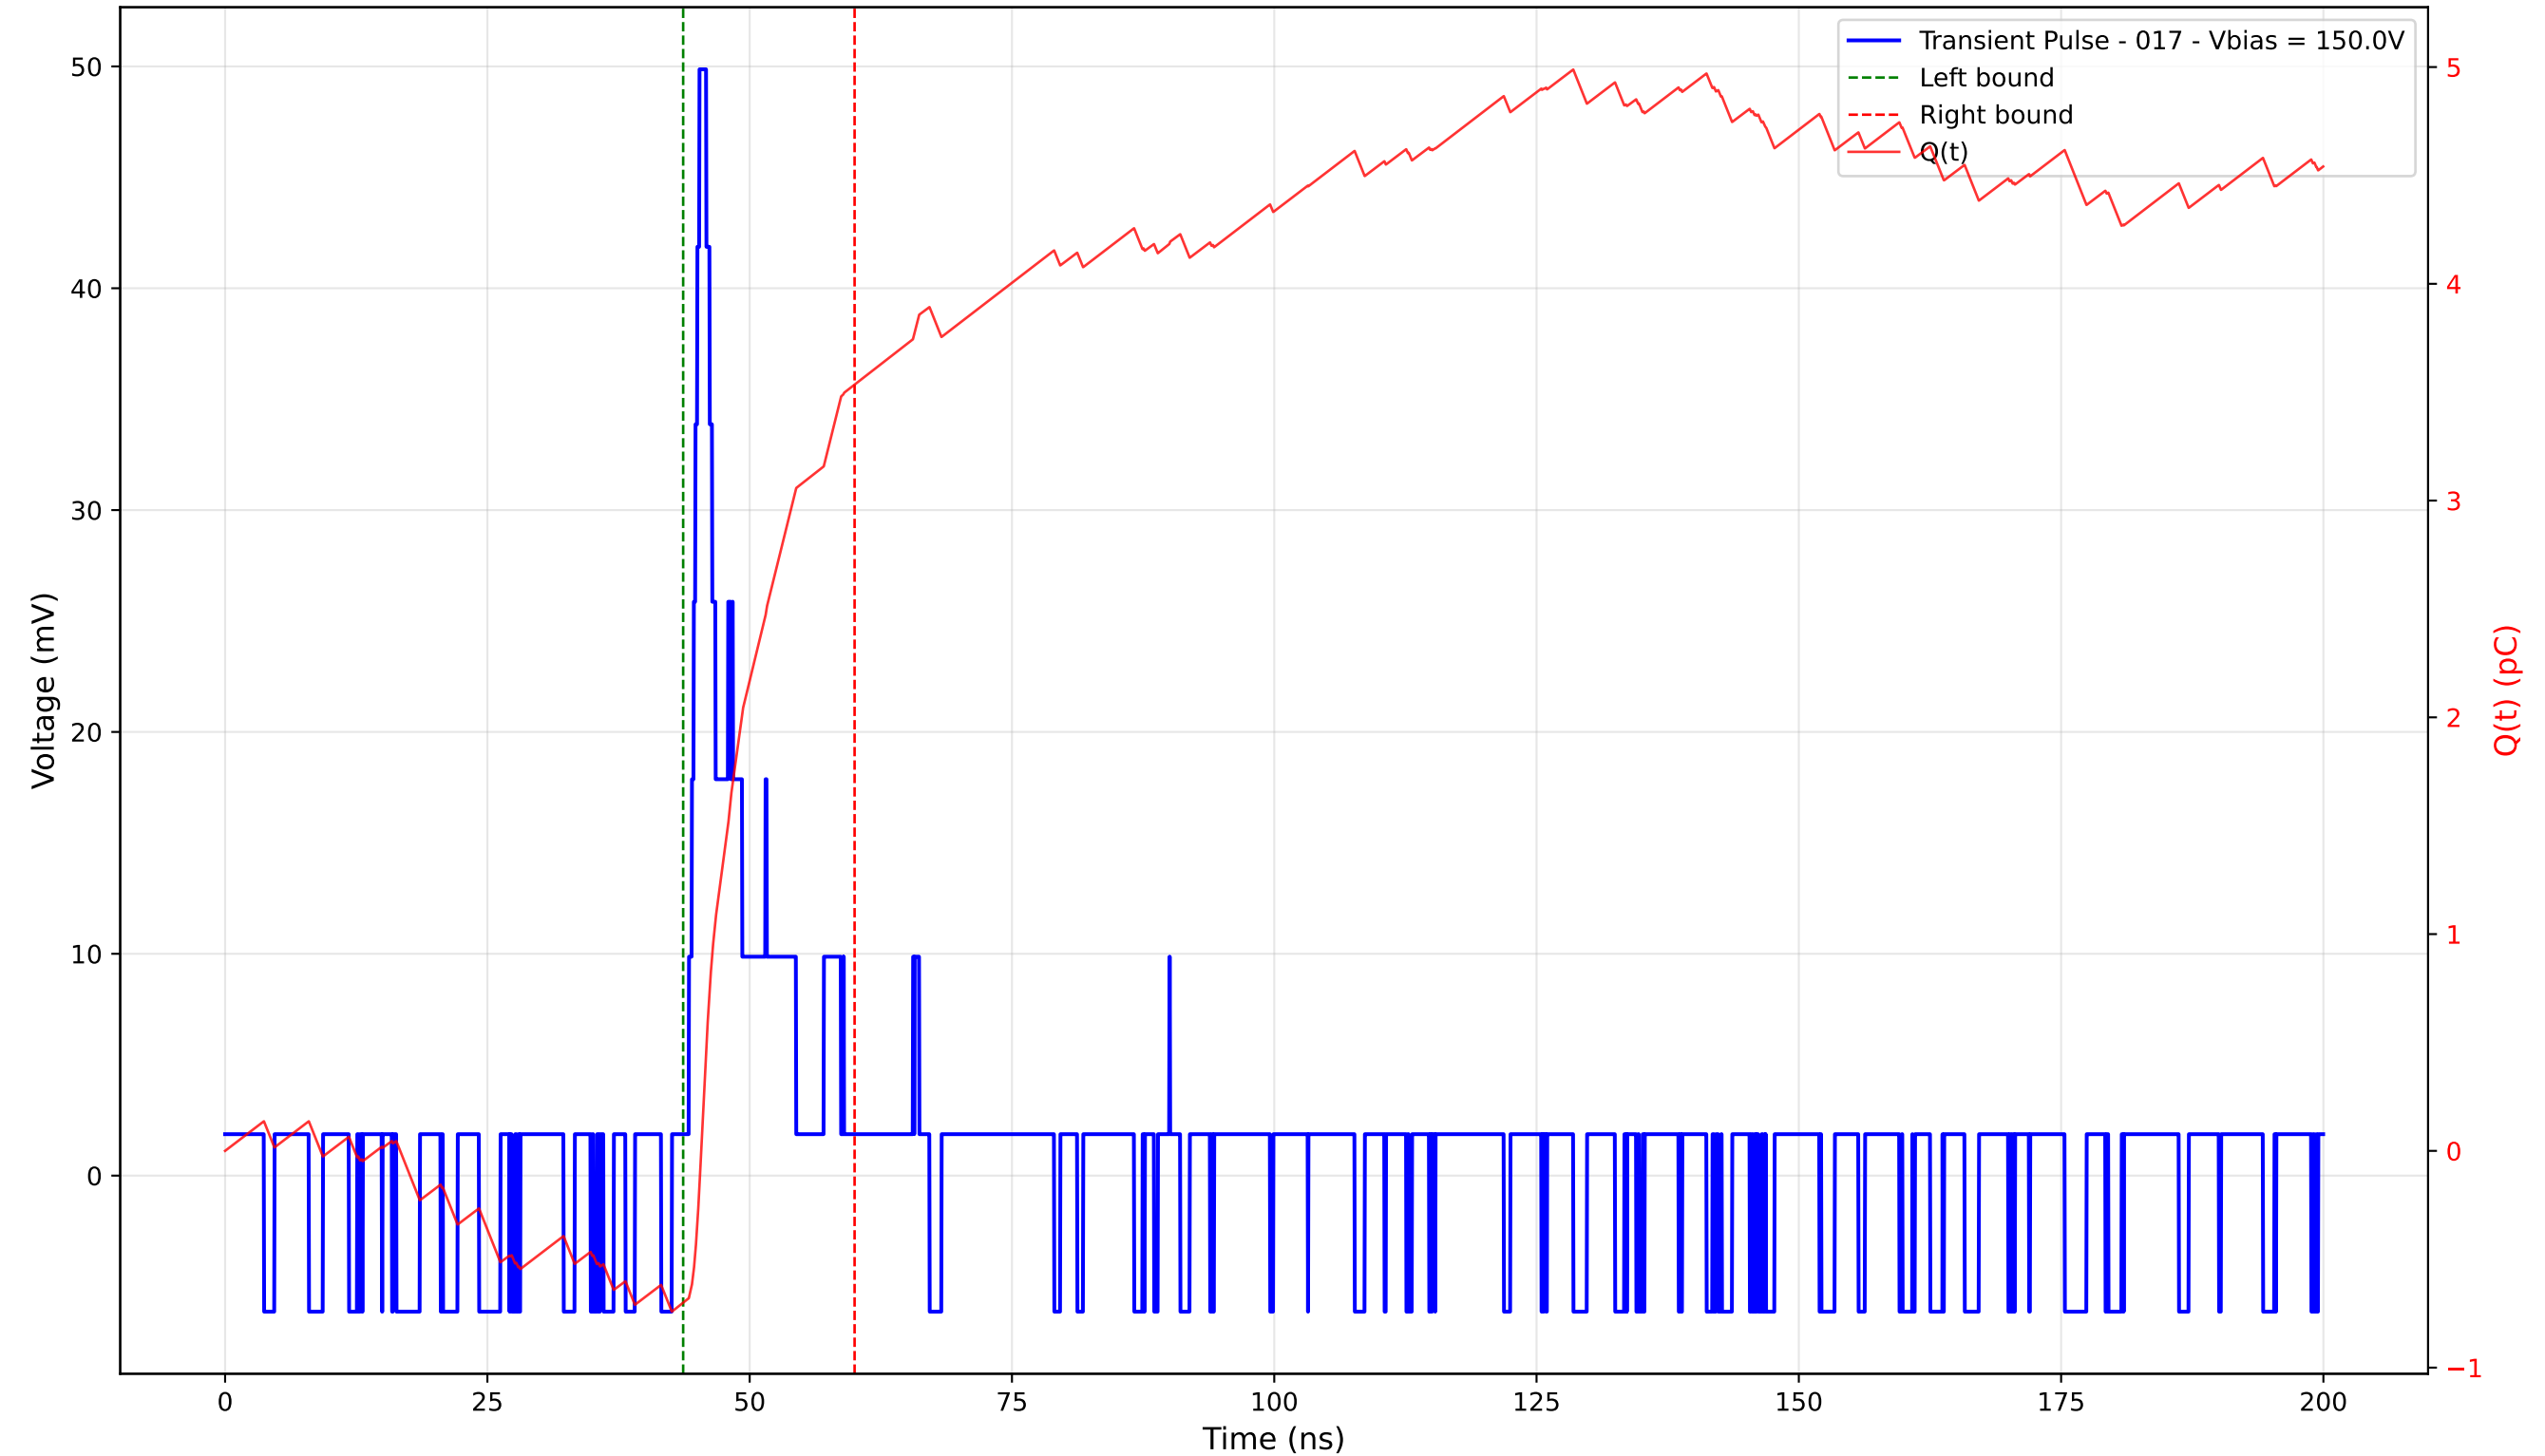


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 9.45 pC - Rise Time: 1.00 ns

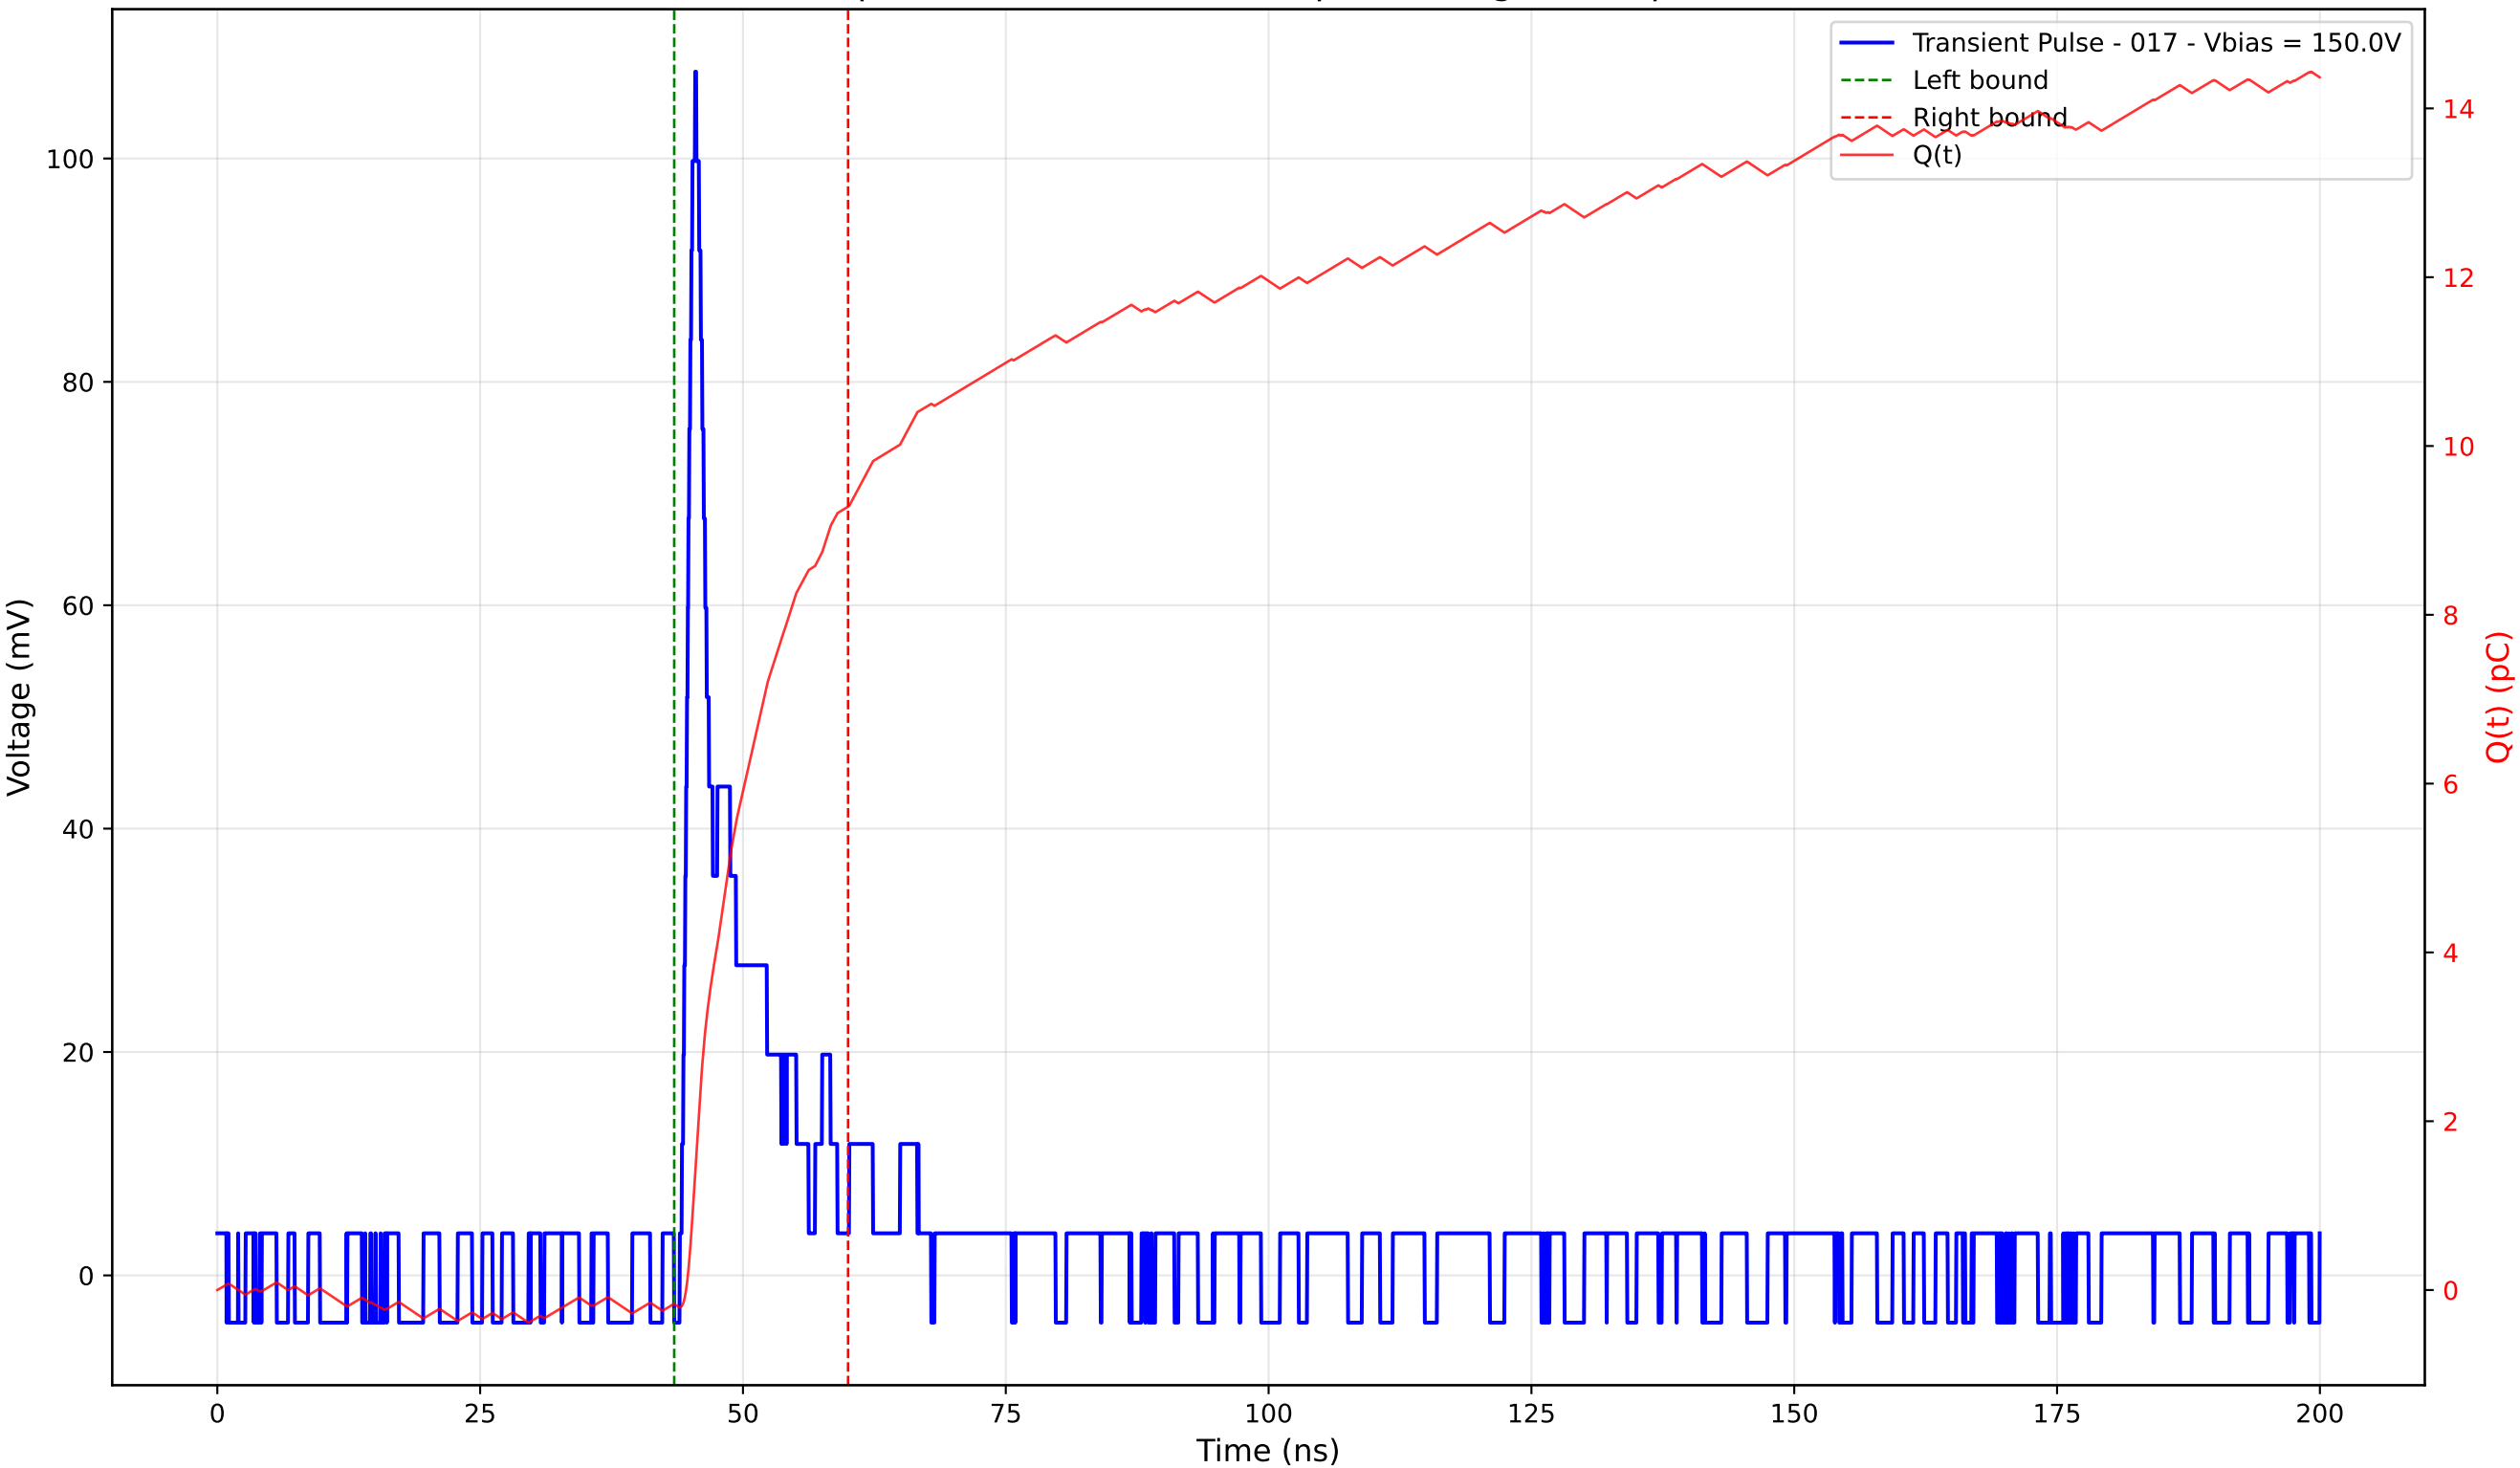


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 15.33 pC - Rise Time: 0.91 ns

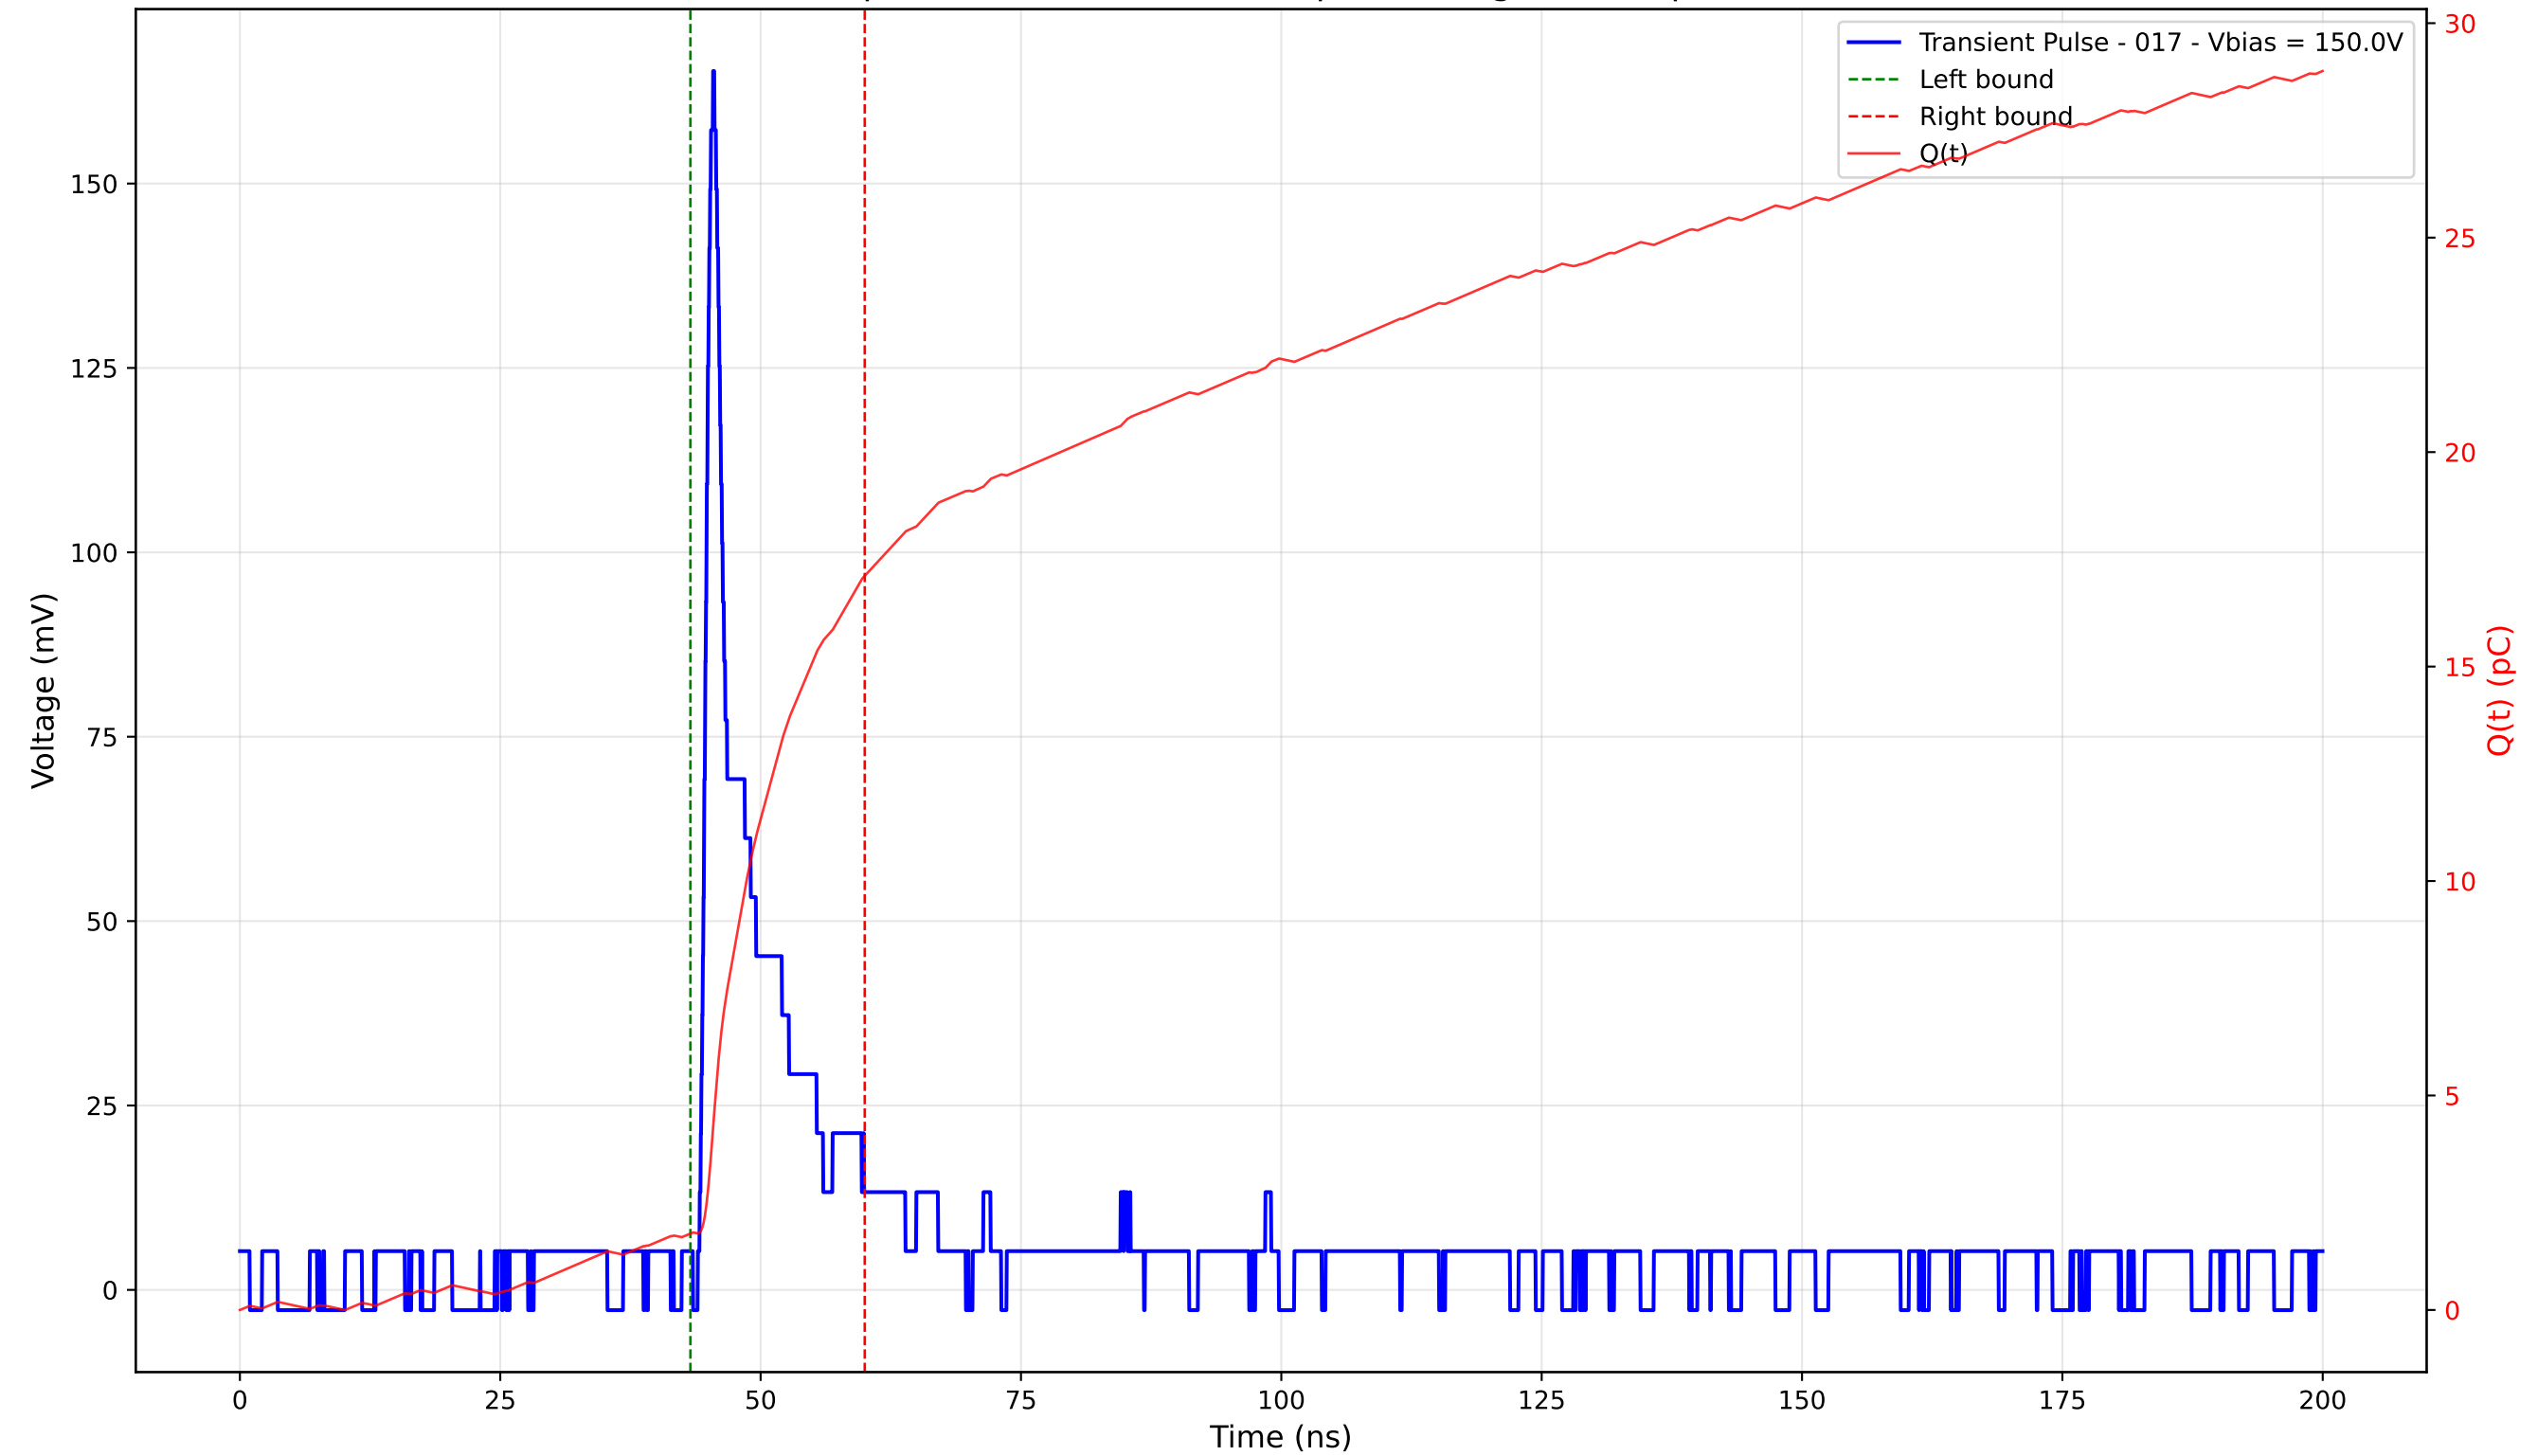


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 20.15 pC - Rise Time: 0.93 ns

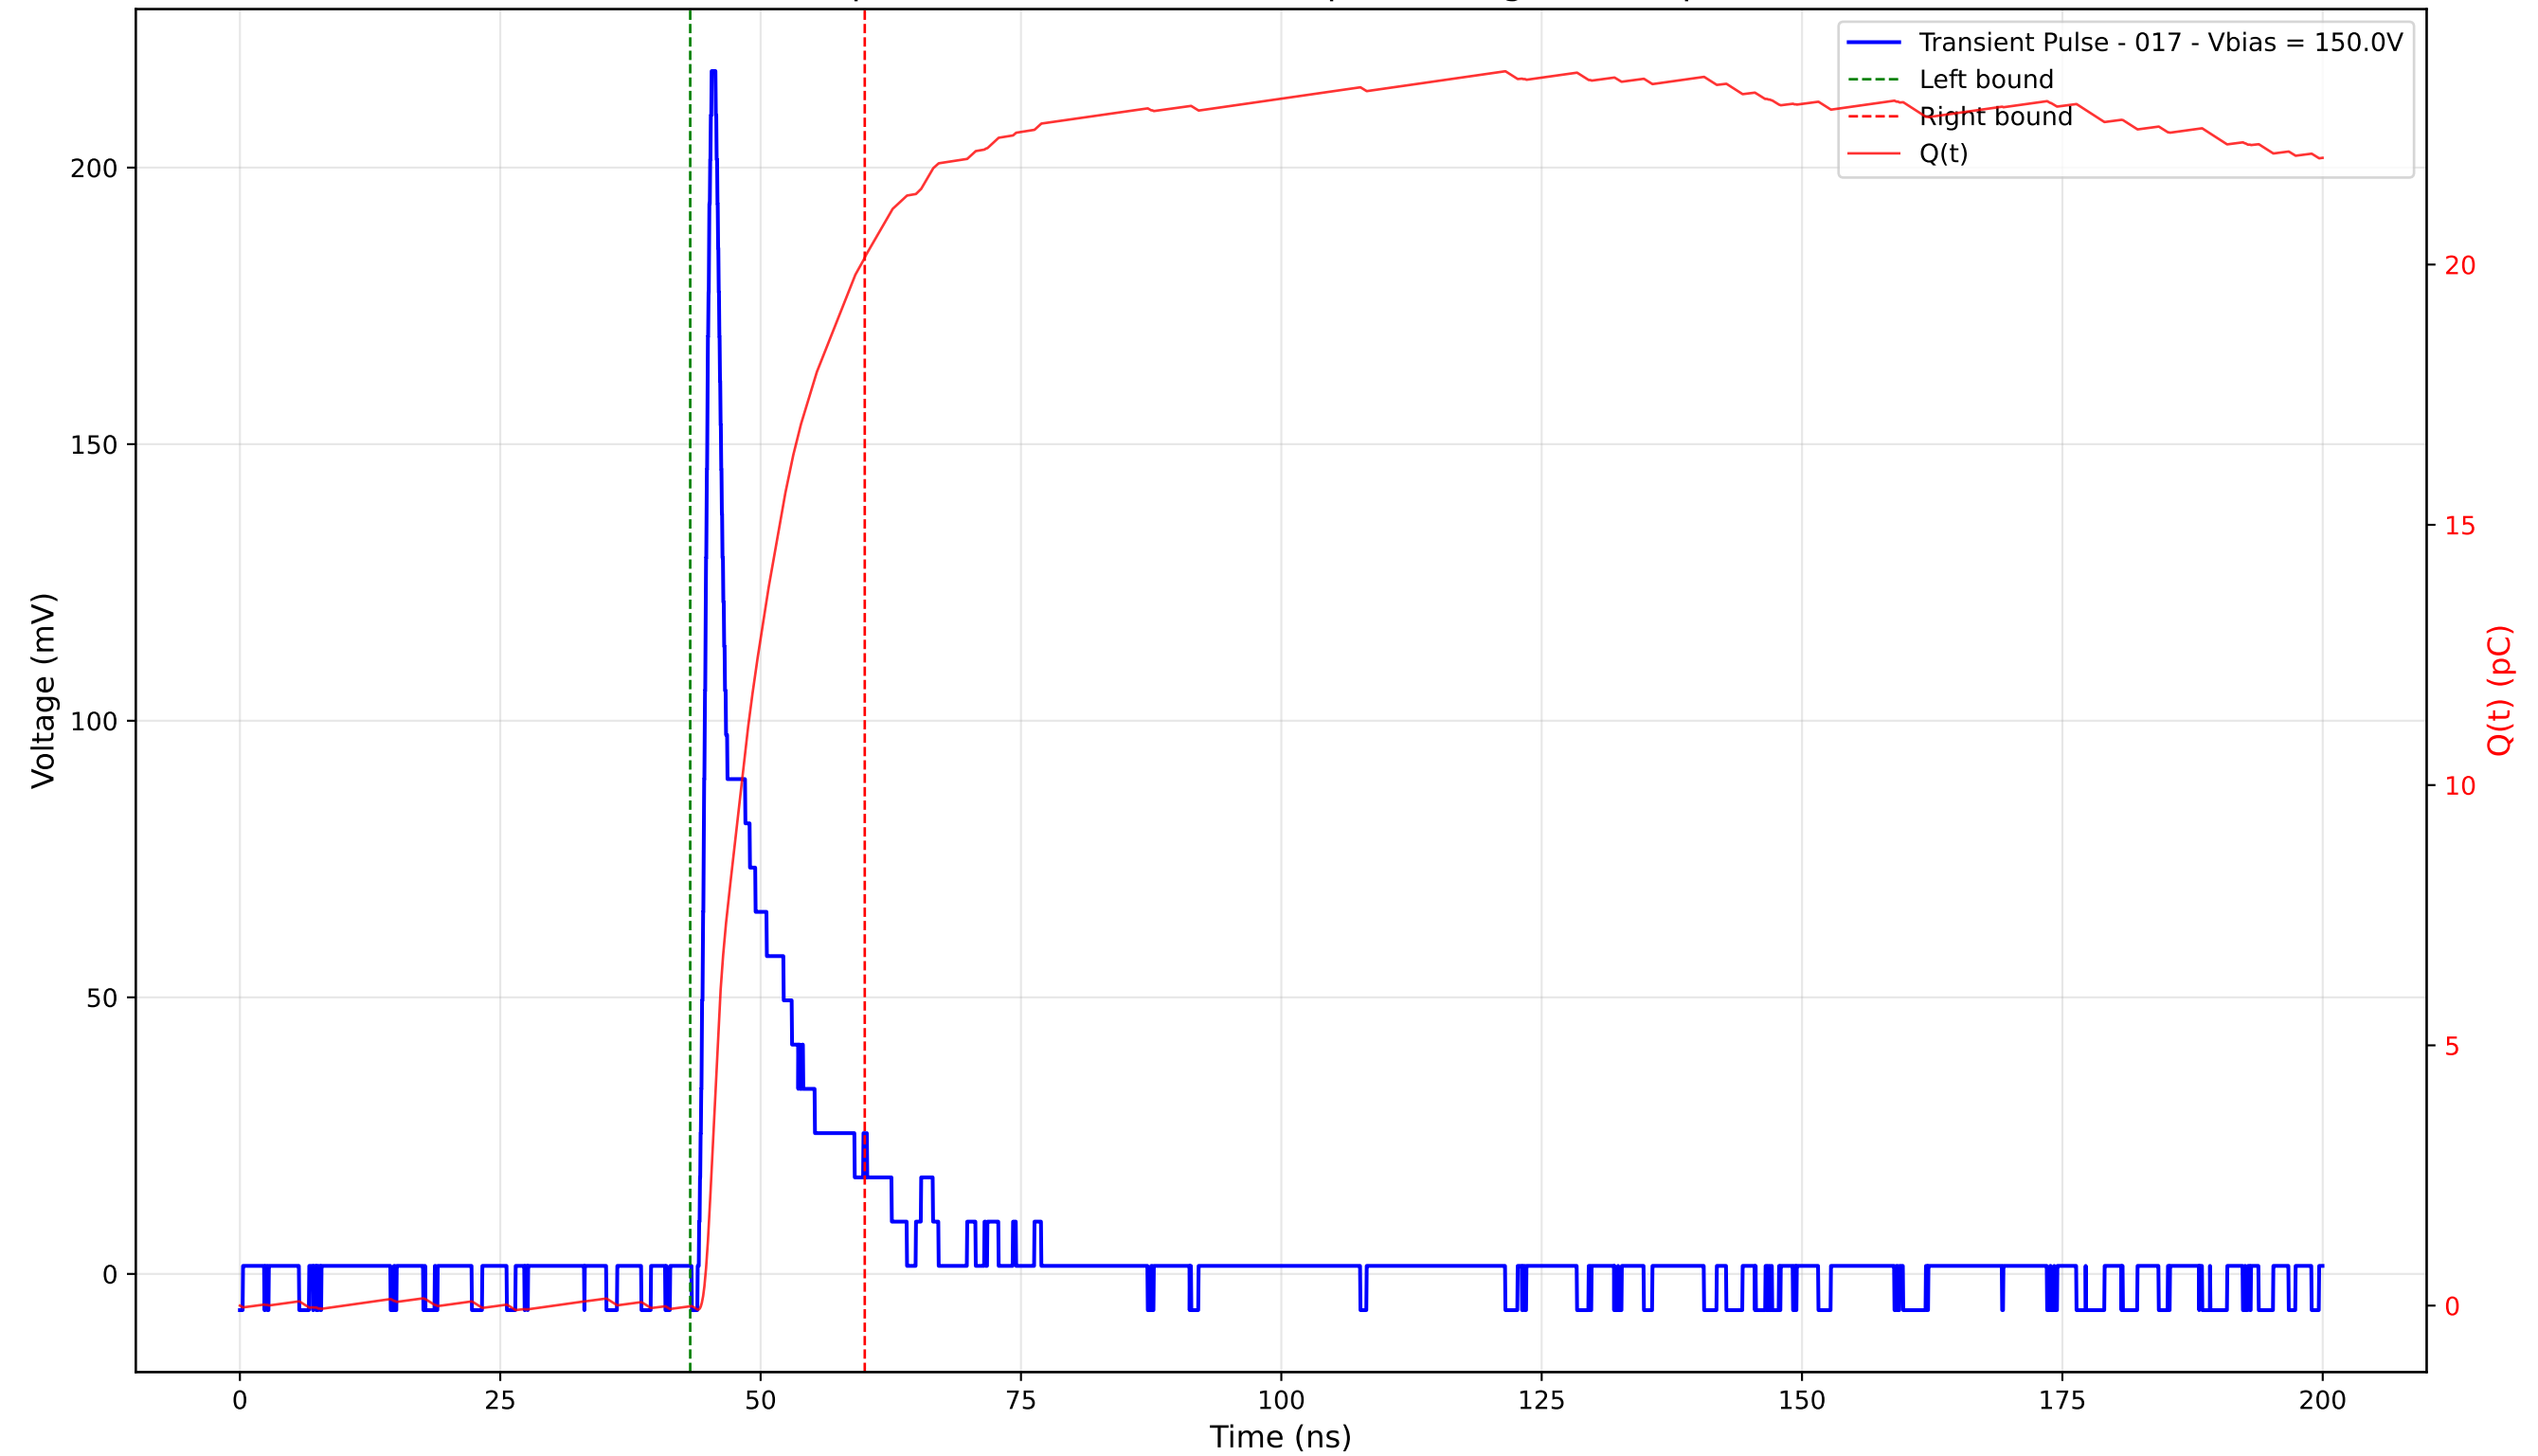


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 26.39 pC - Rise Time: 0.89 ns

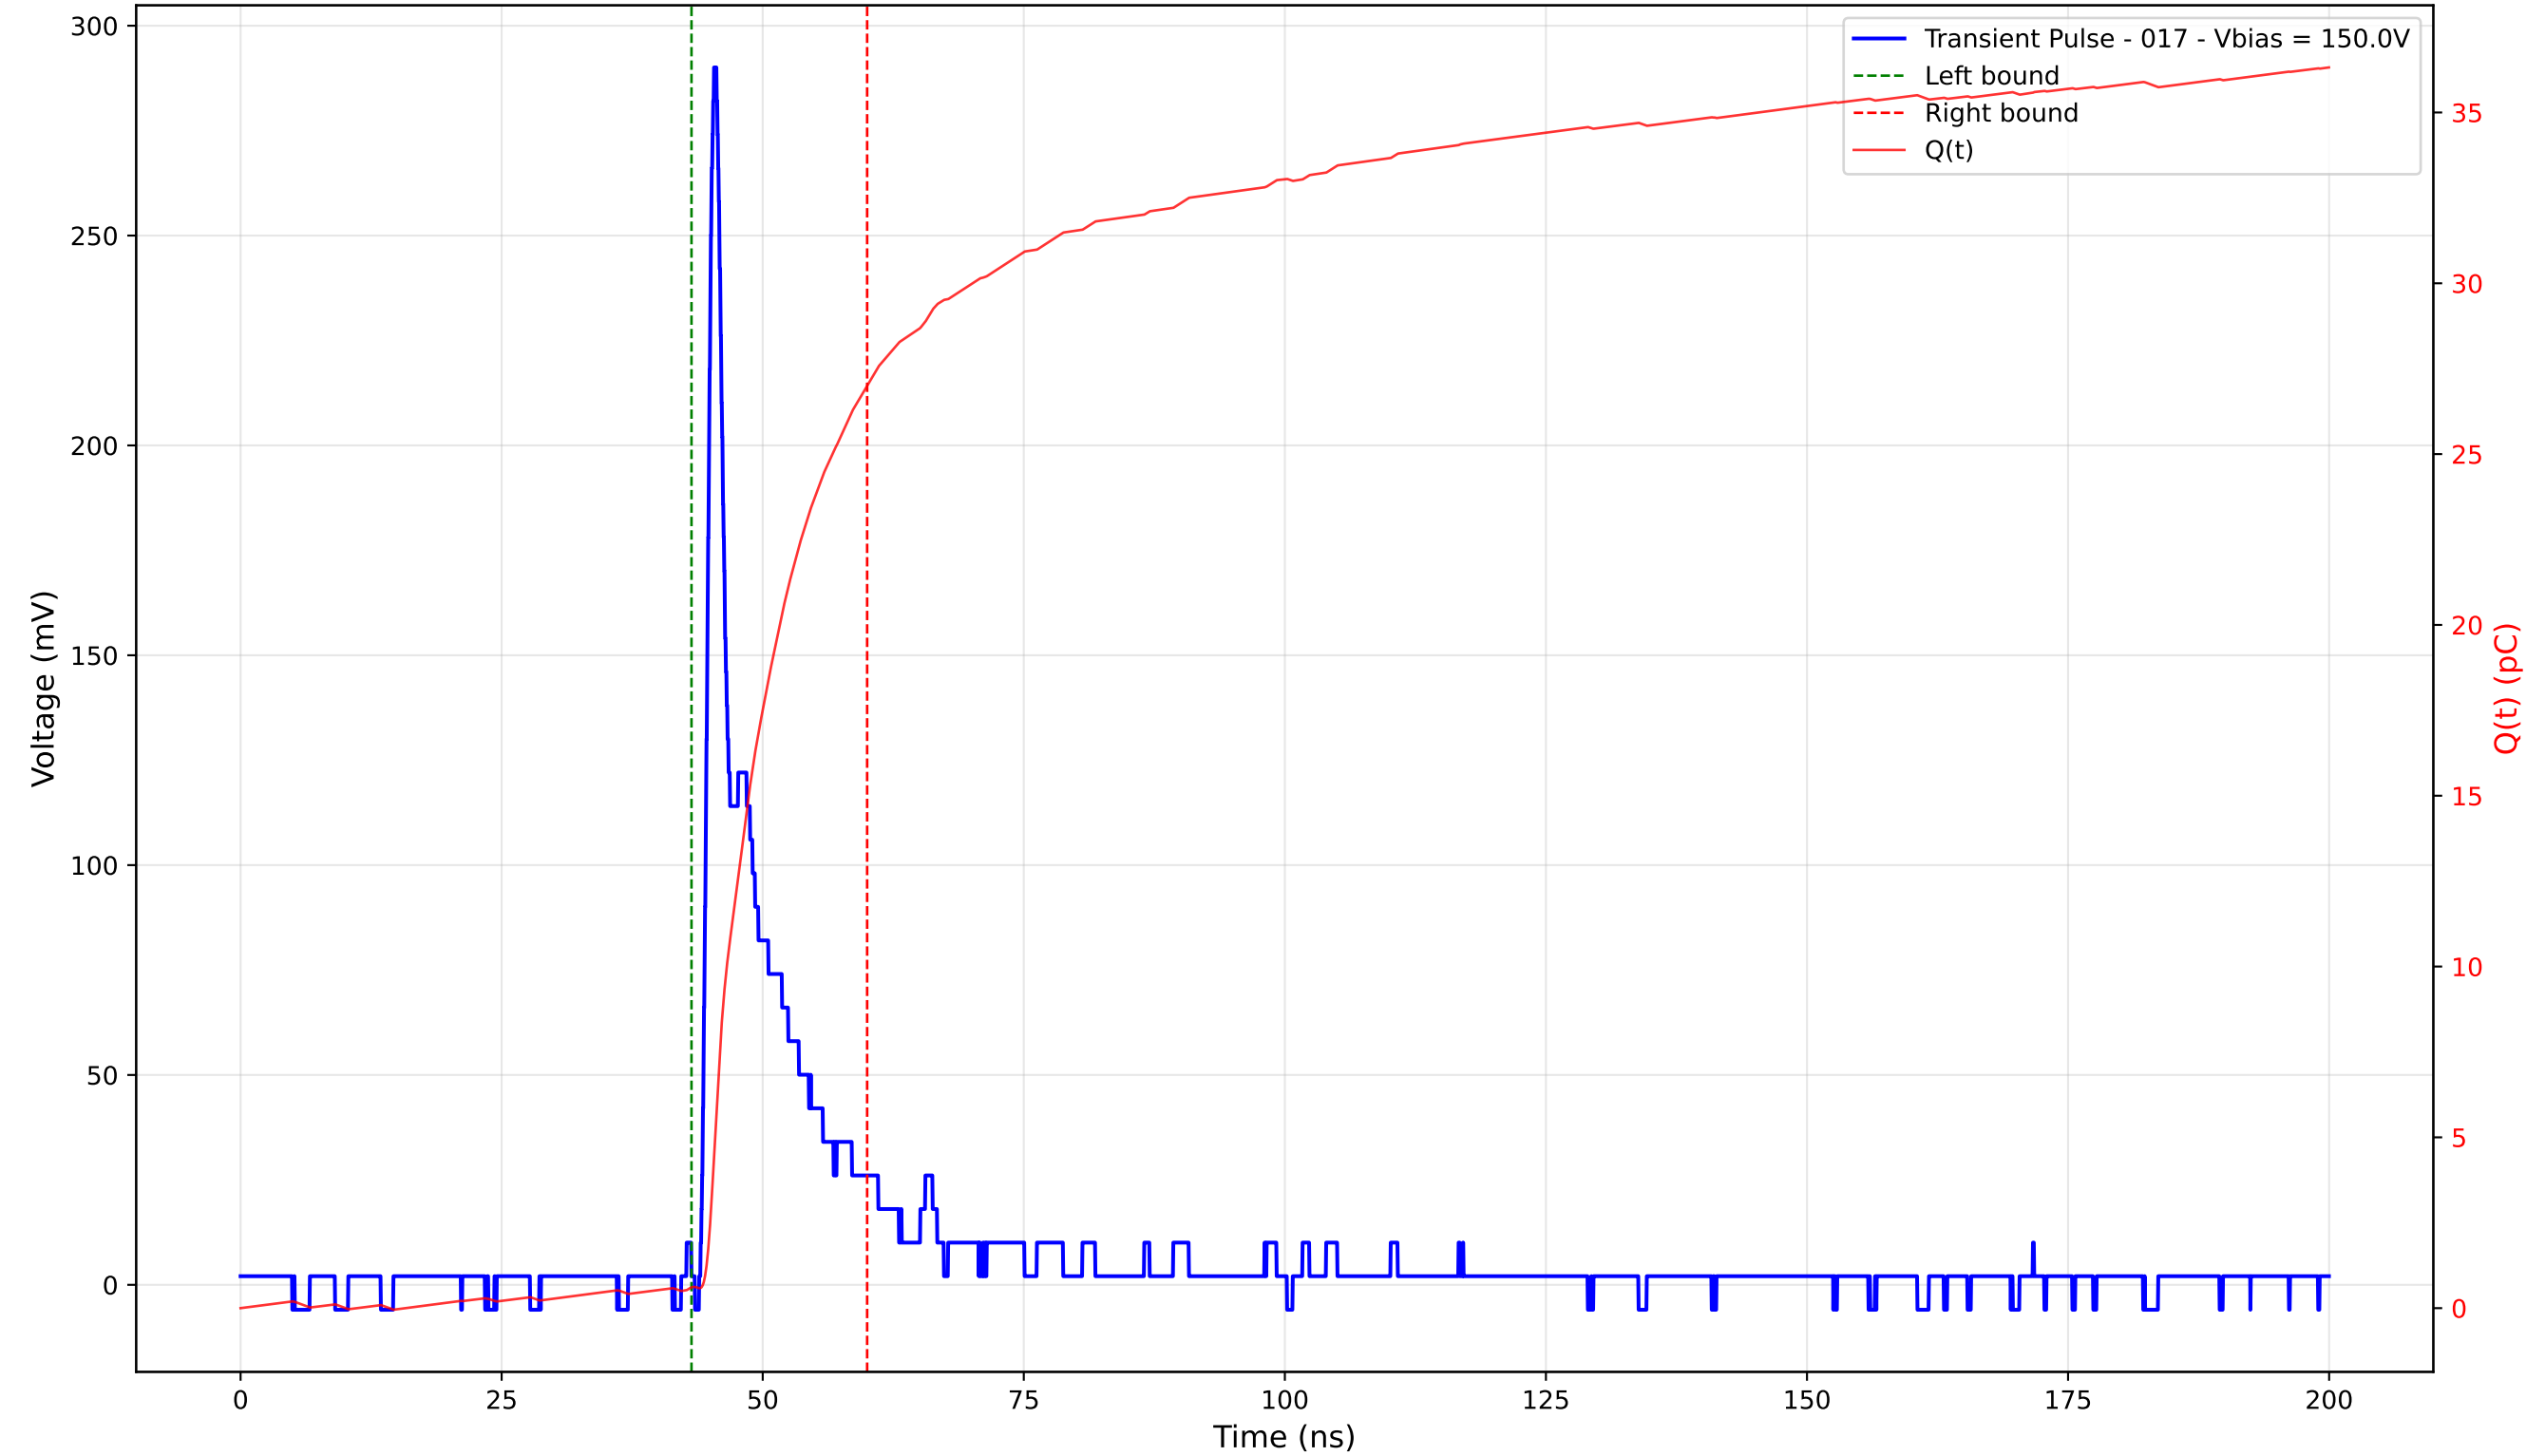


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 31.90 pC - Rise Time: 0.88 ns

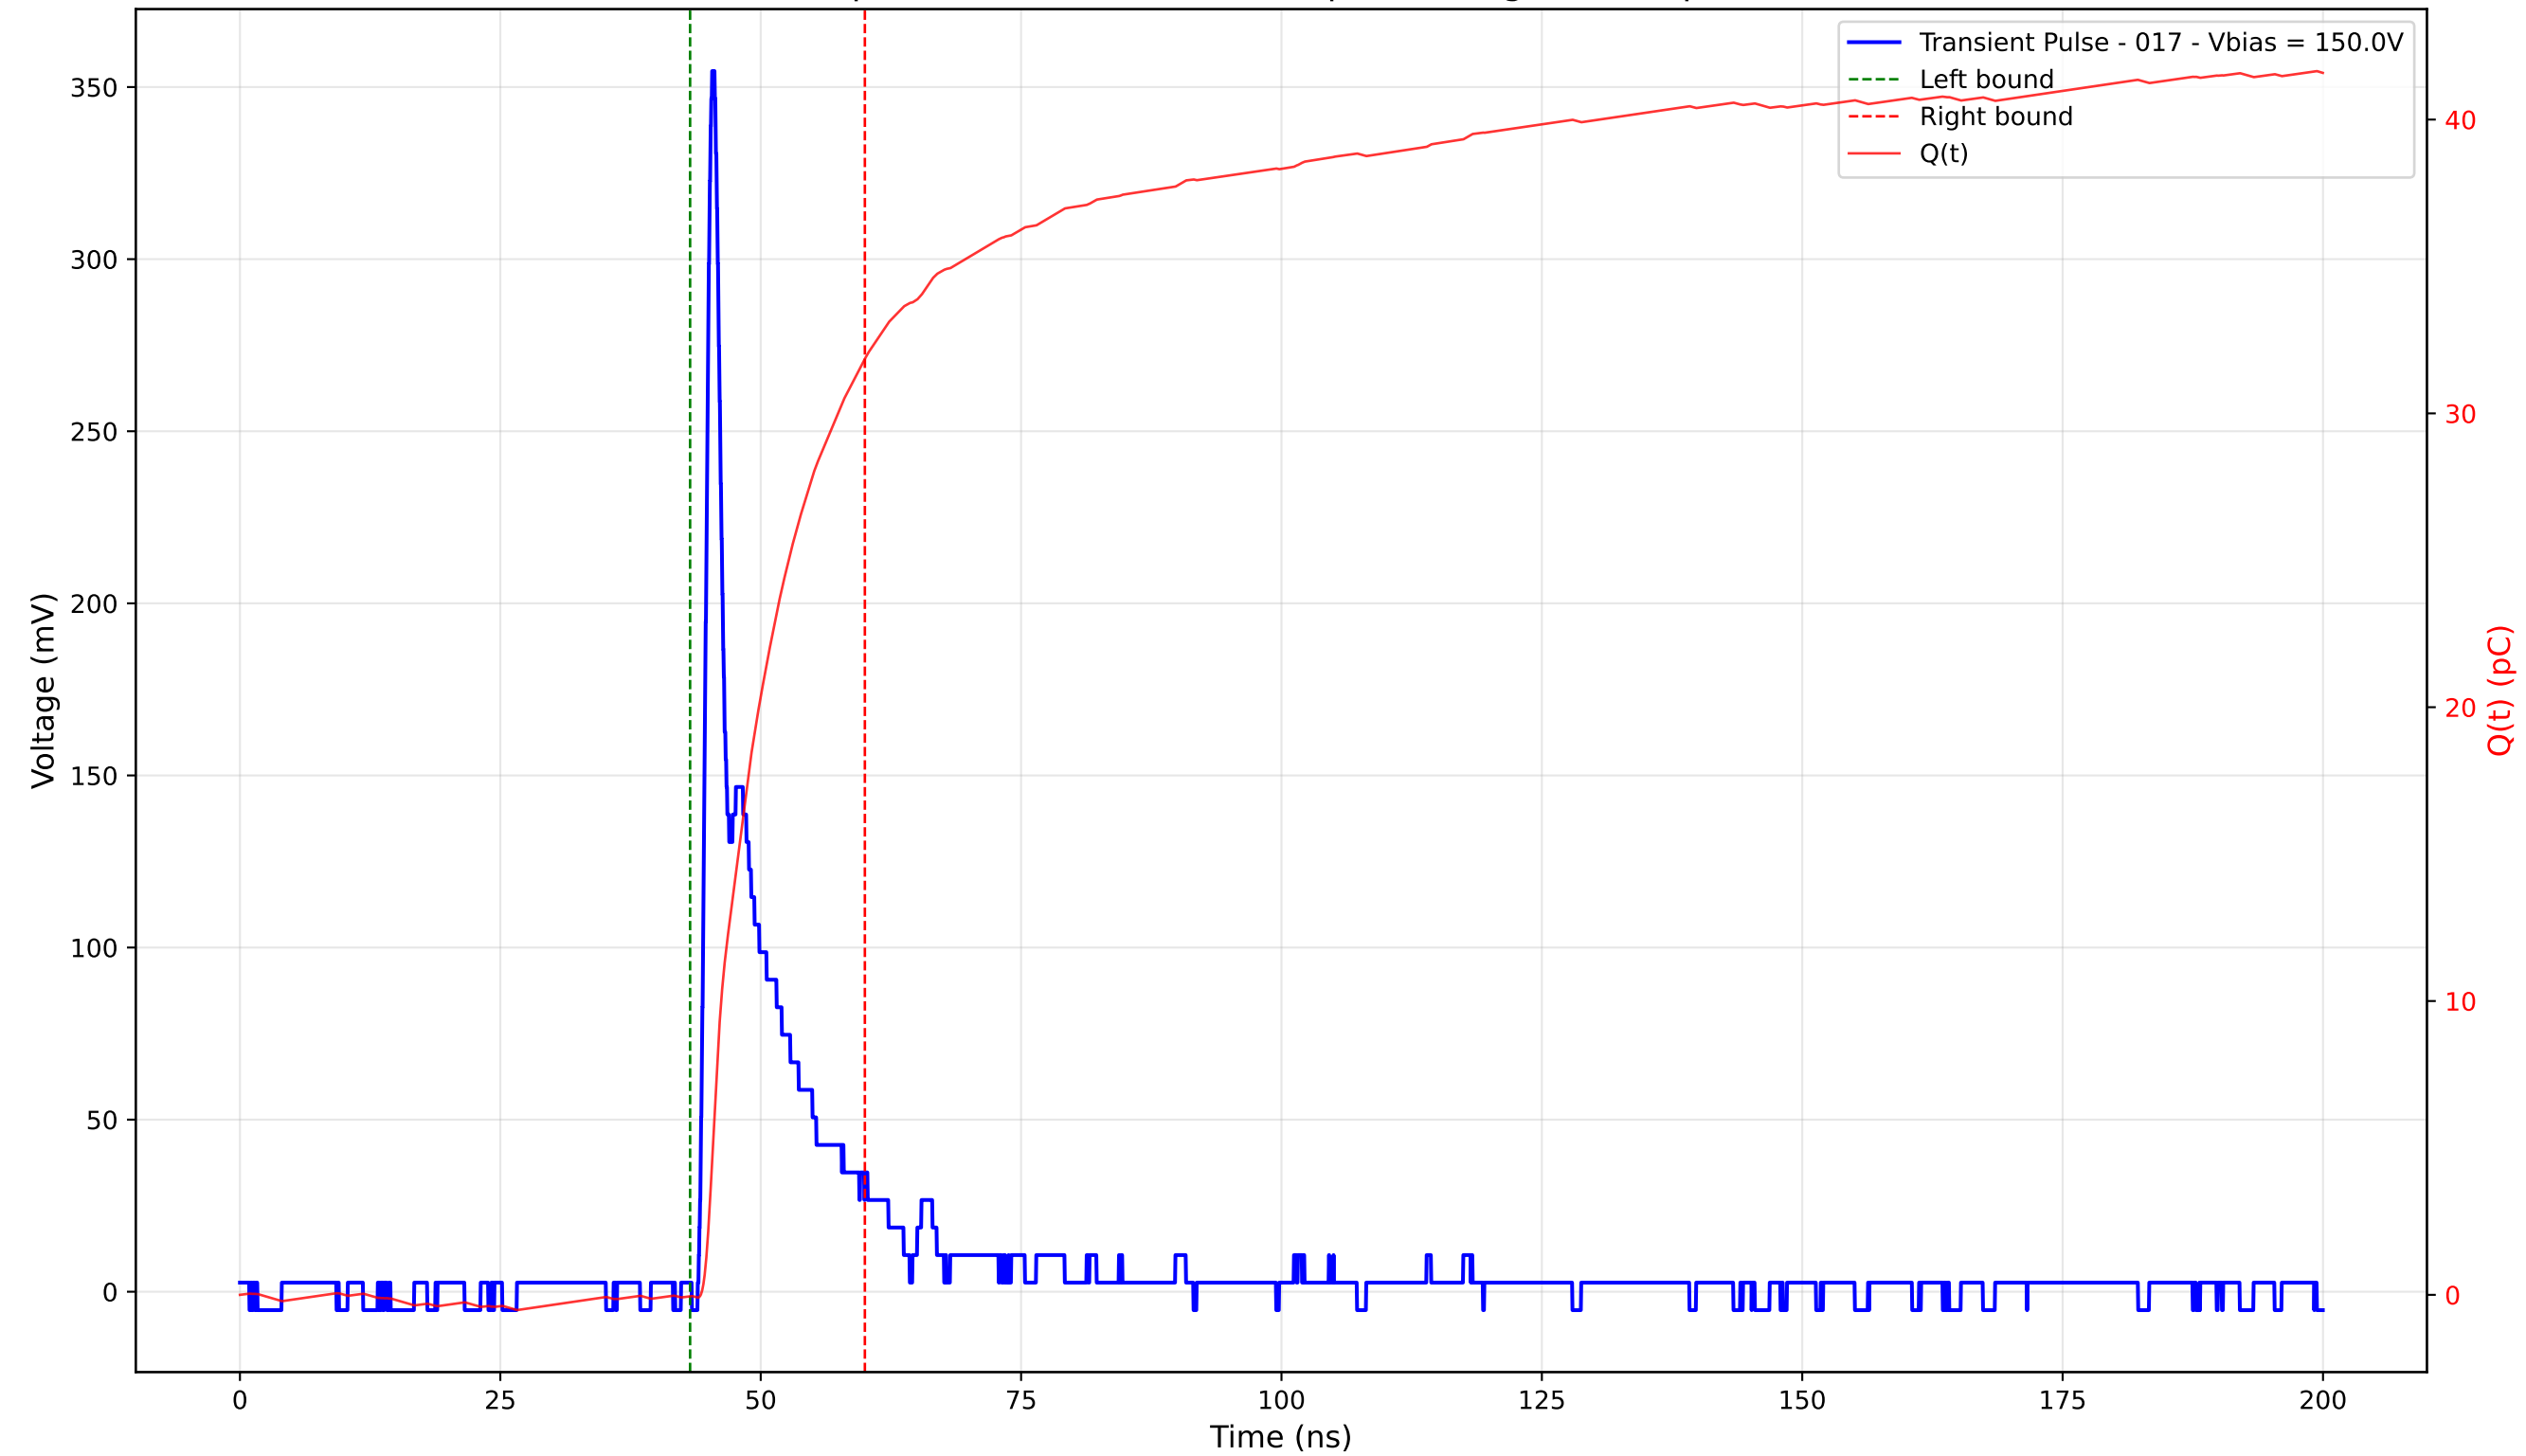


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 36.24 pC - Rise Time: 0.90 ns

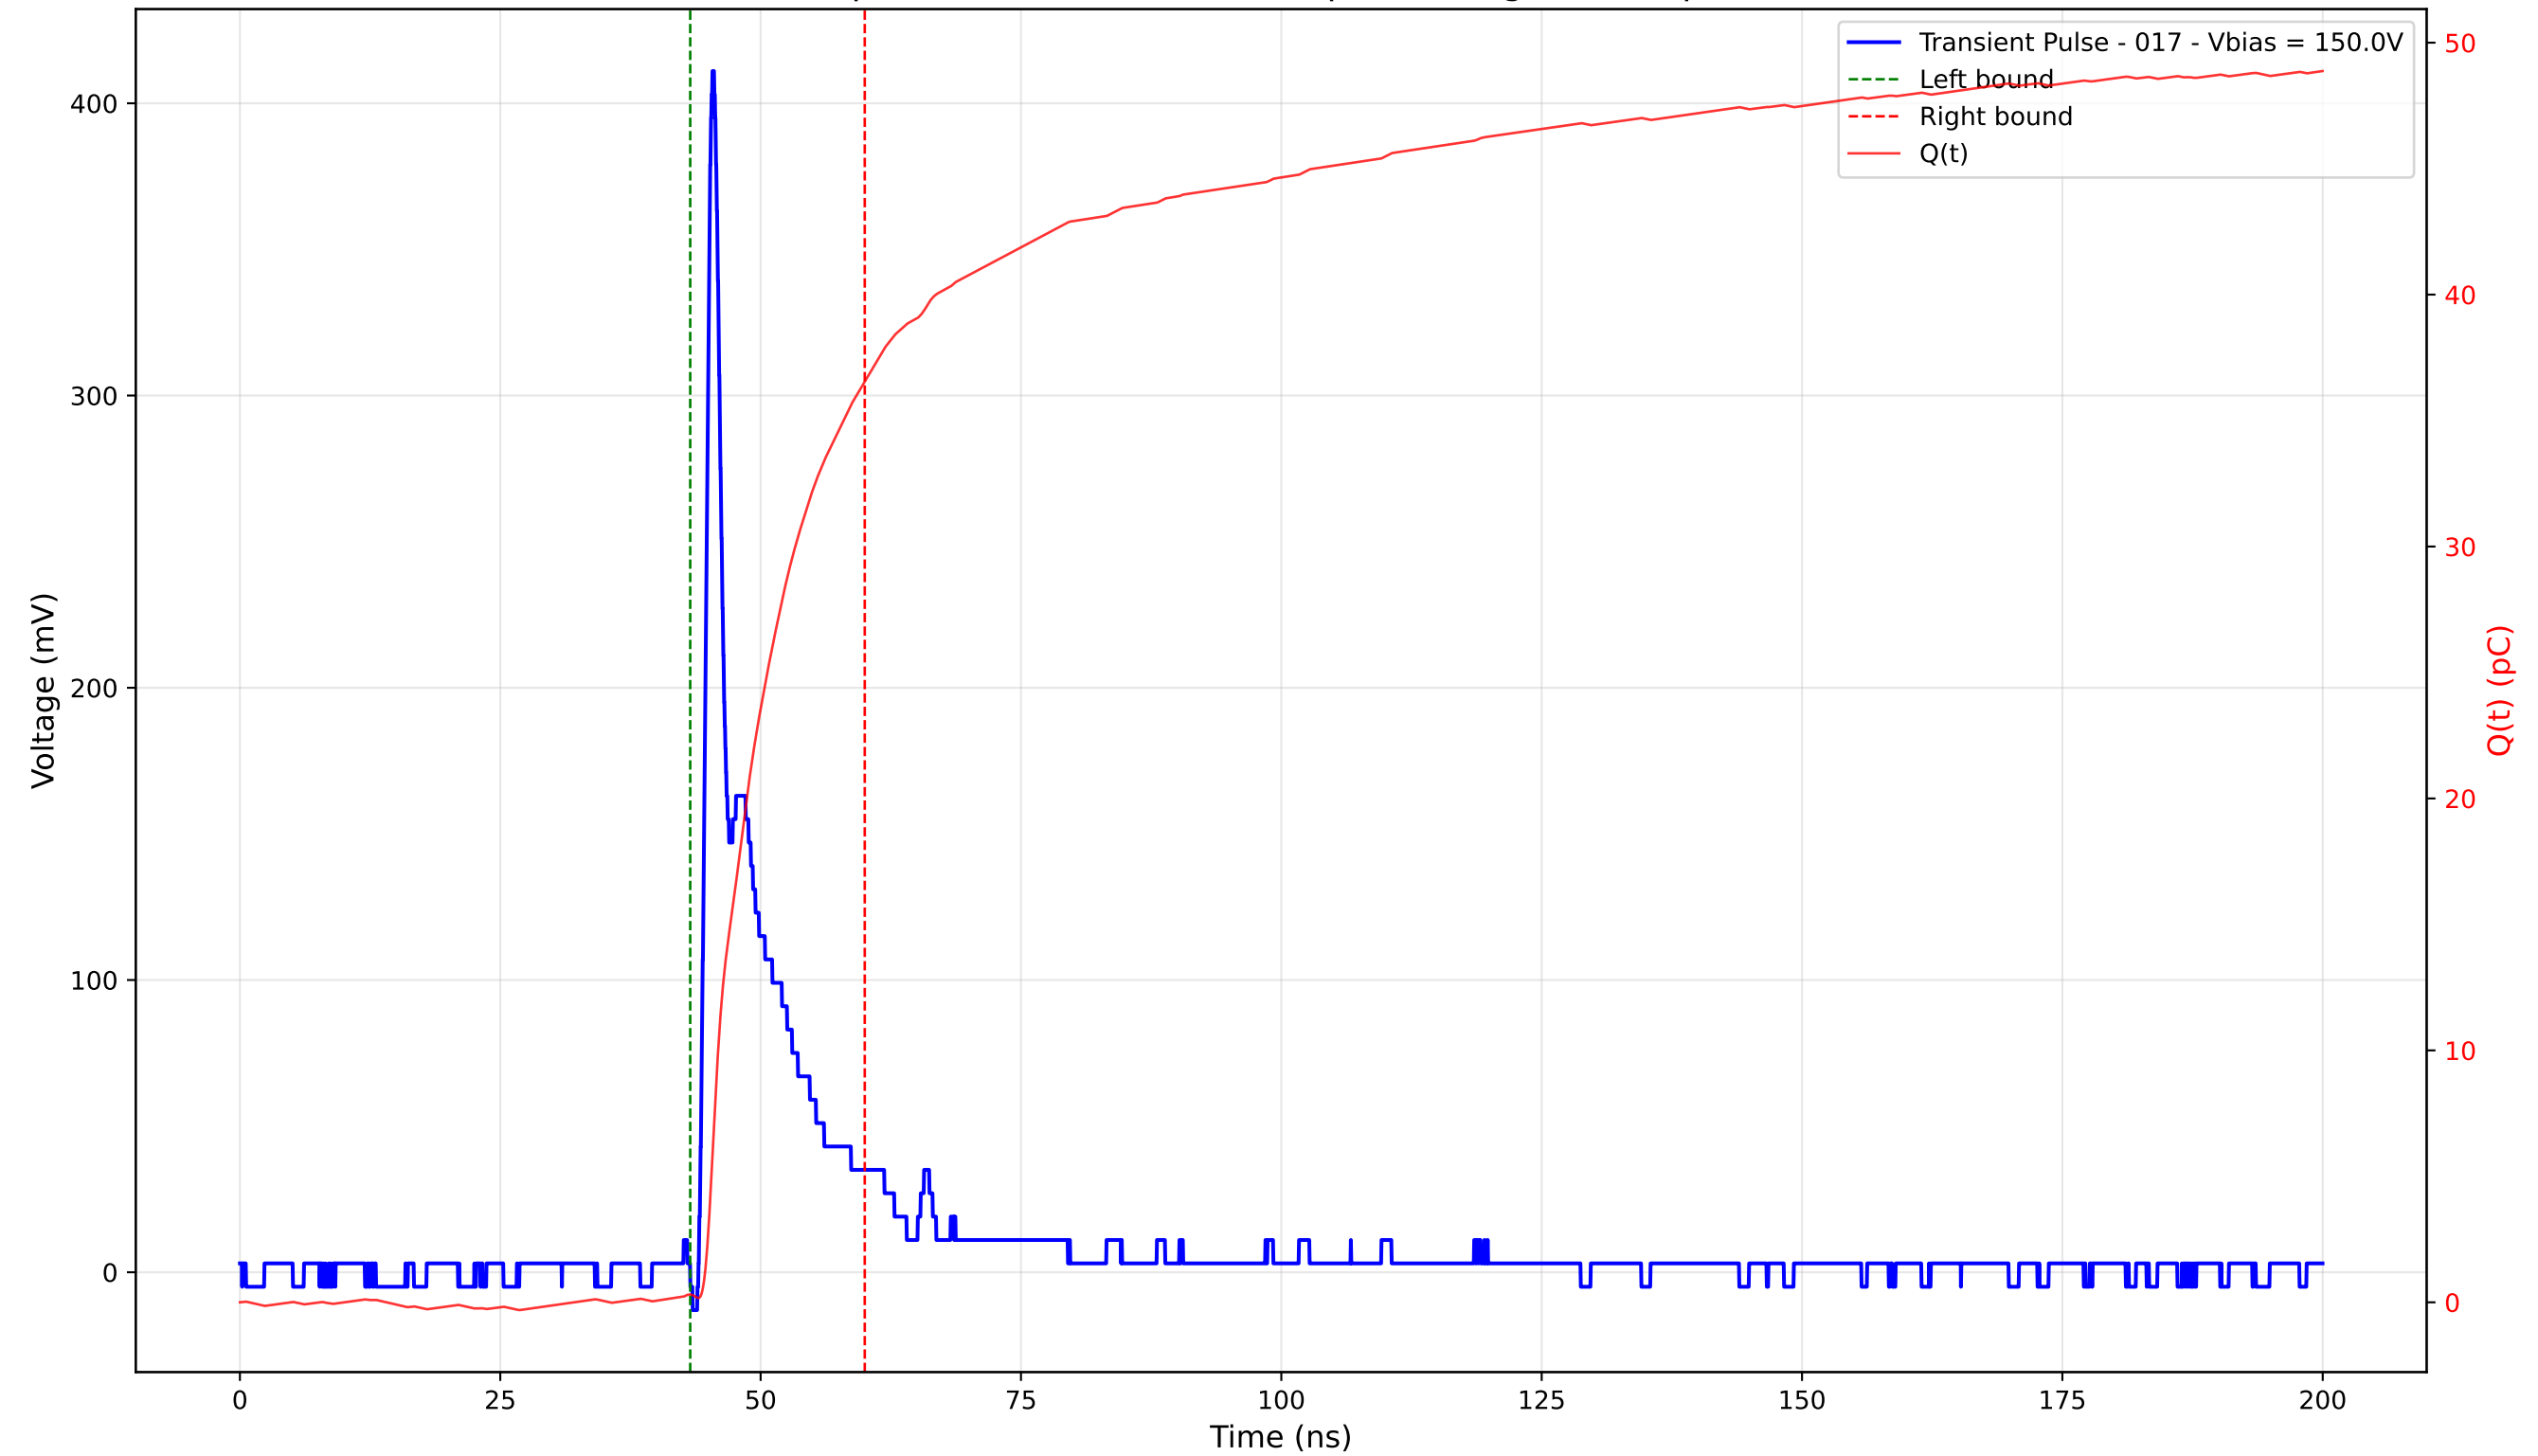


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 38.21 pC - Rise Time: 0.91 ns

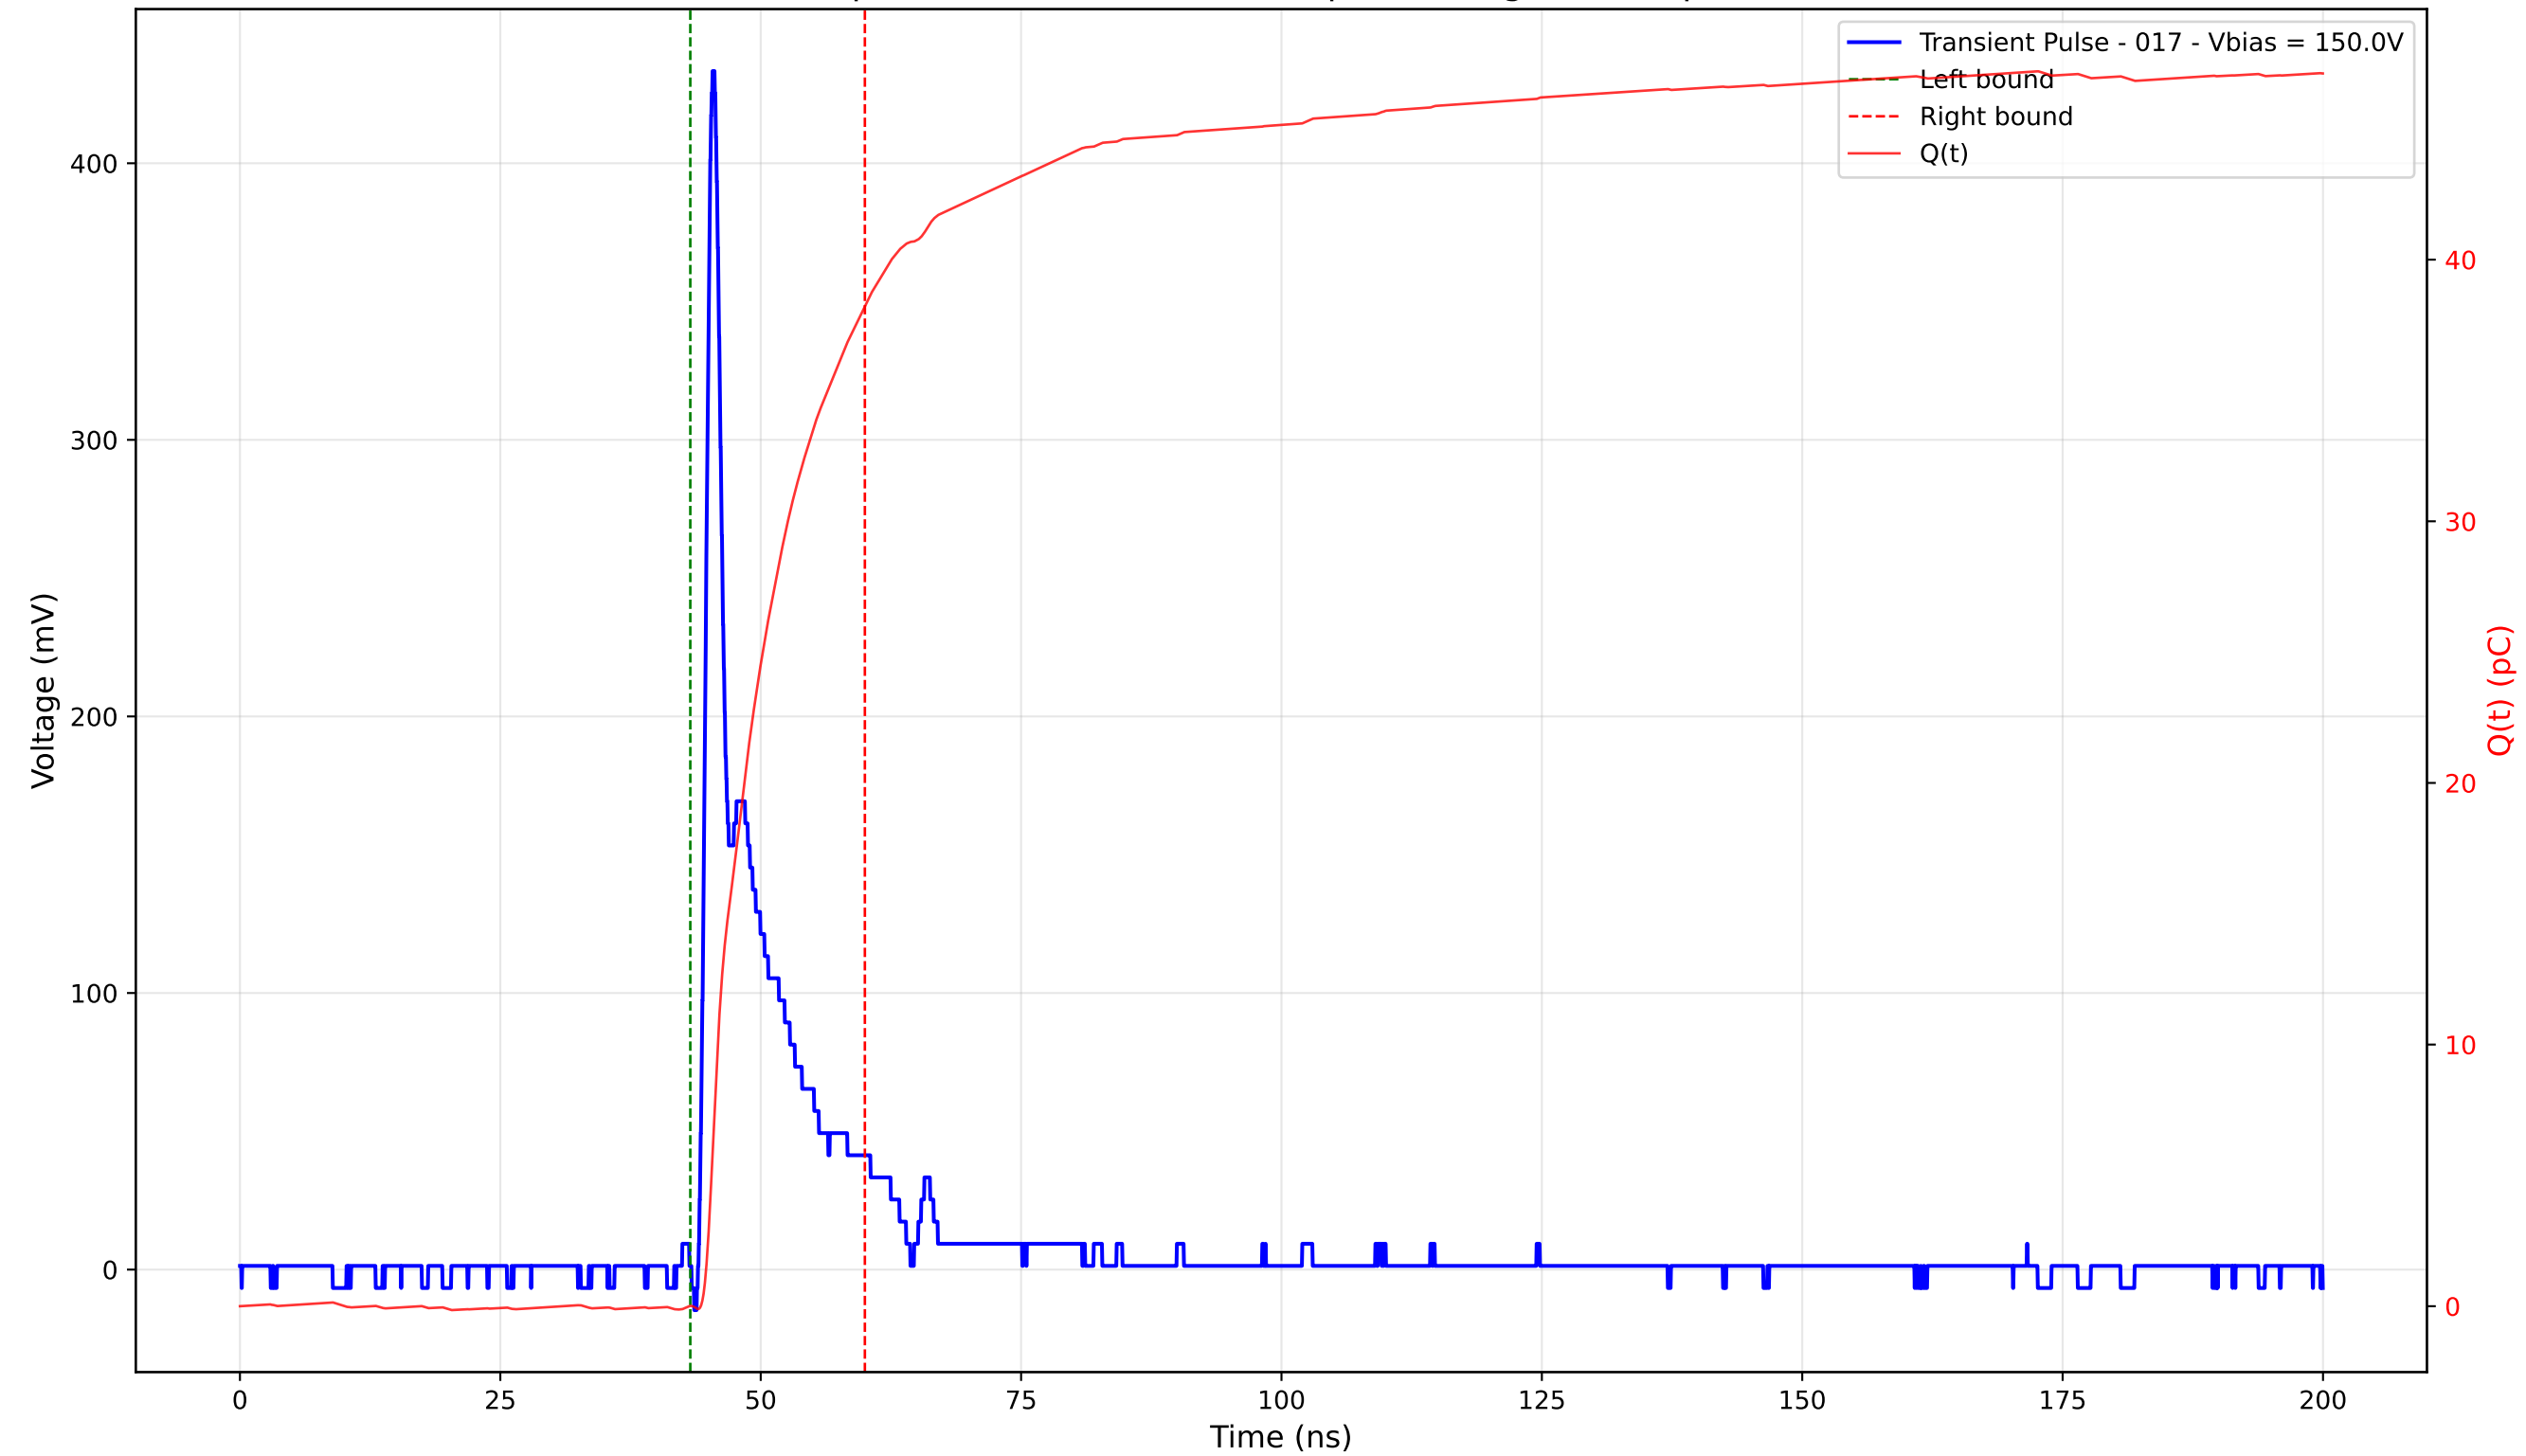


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 40.68 pC - Rise Time: 0.90 ns

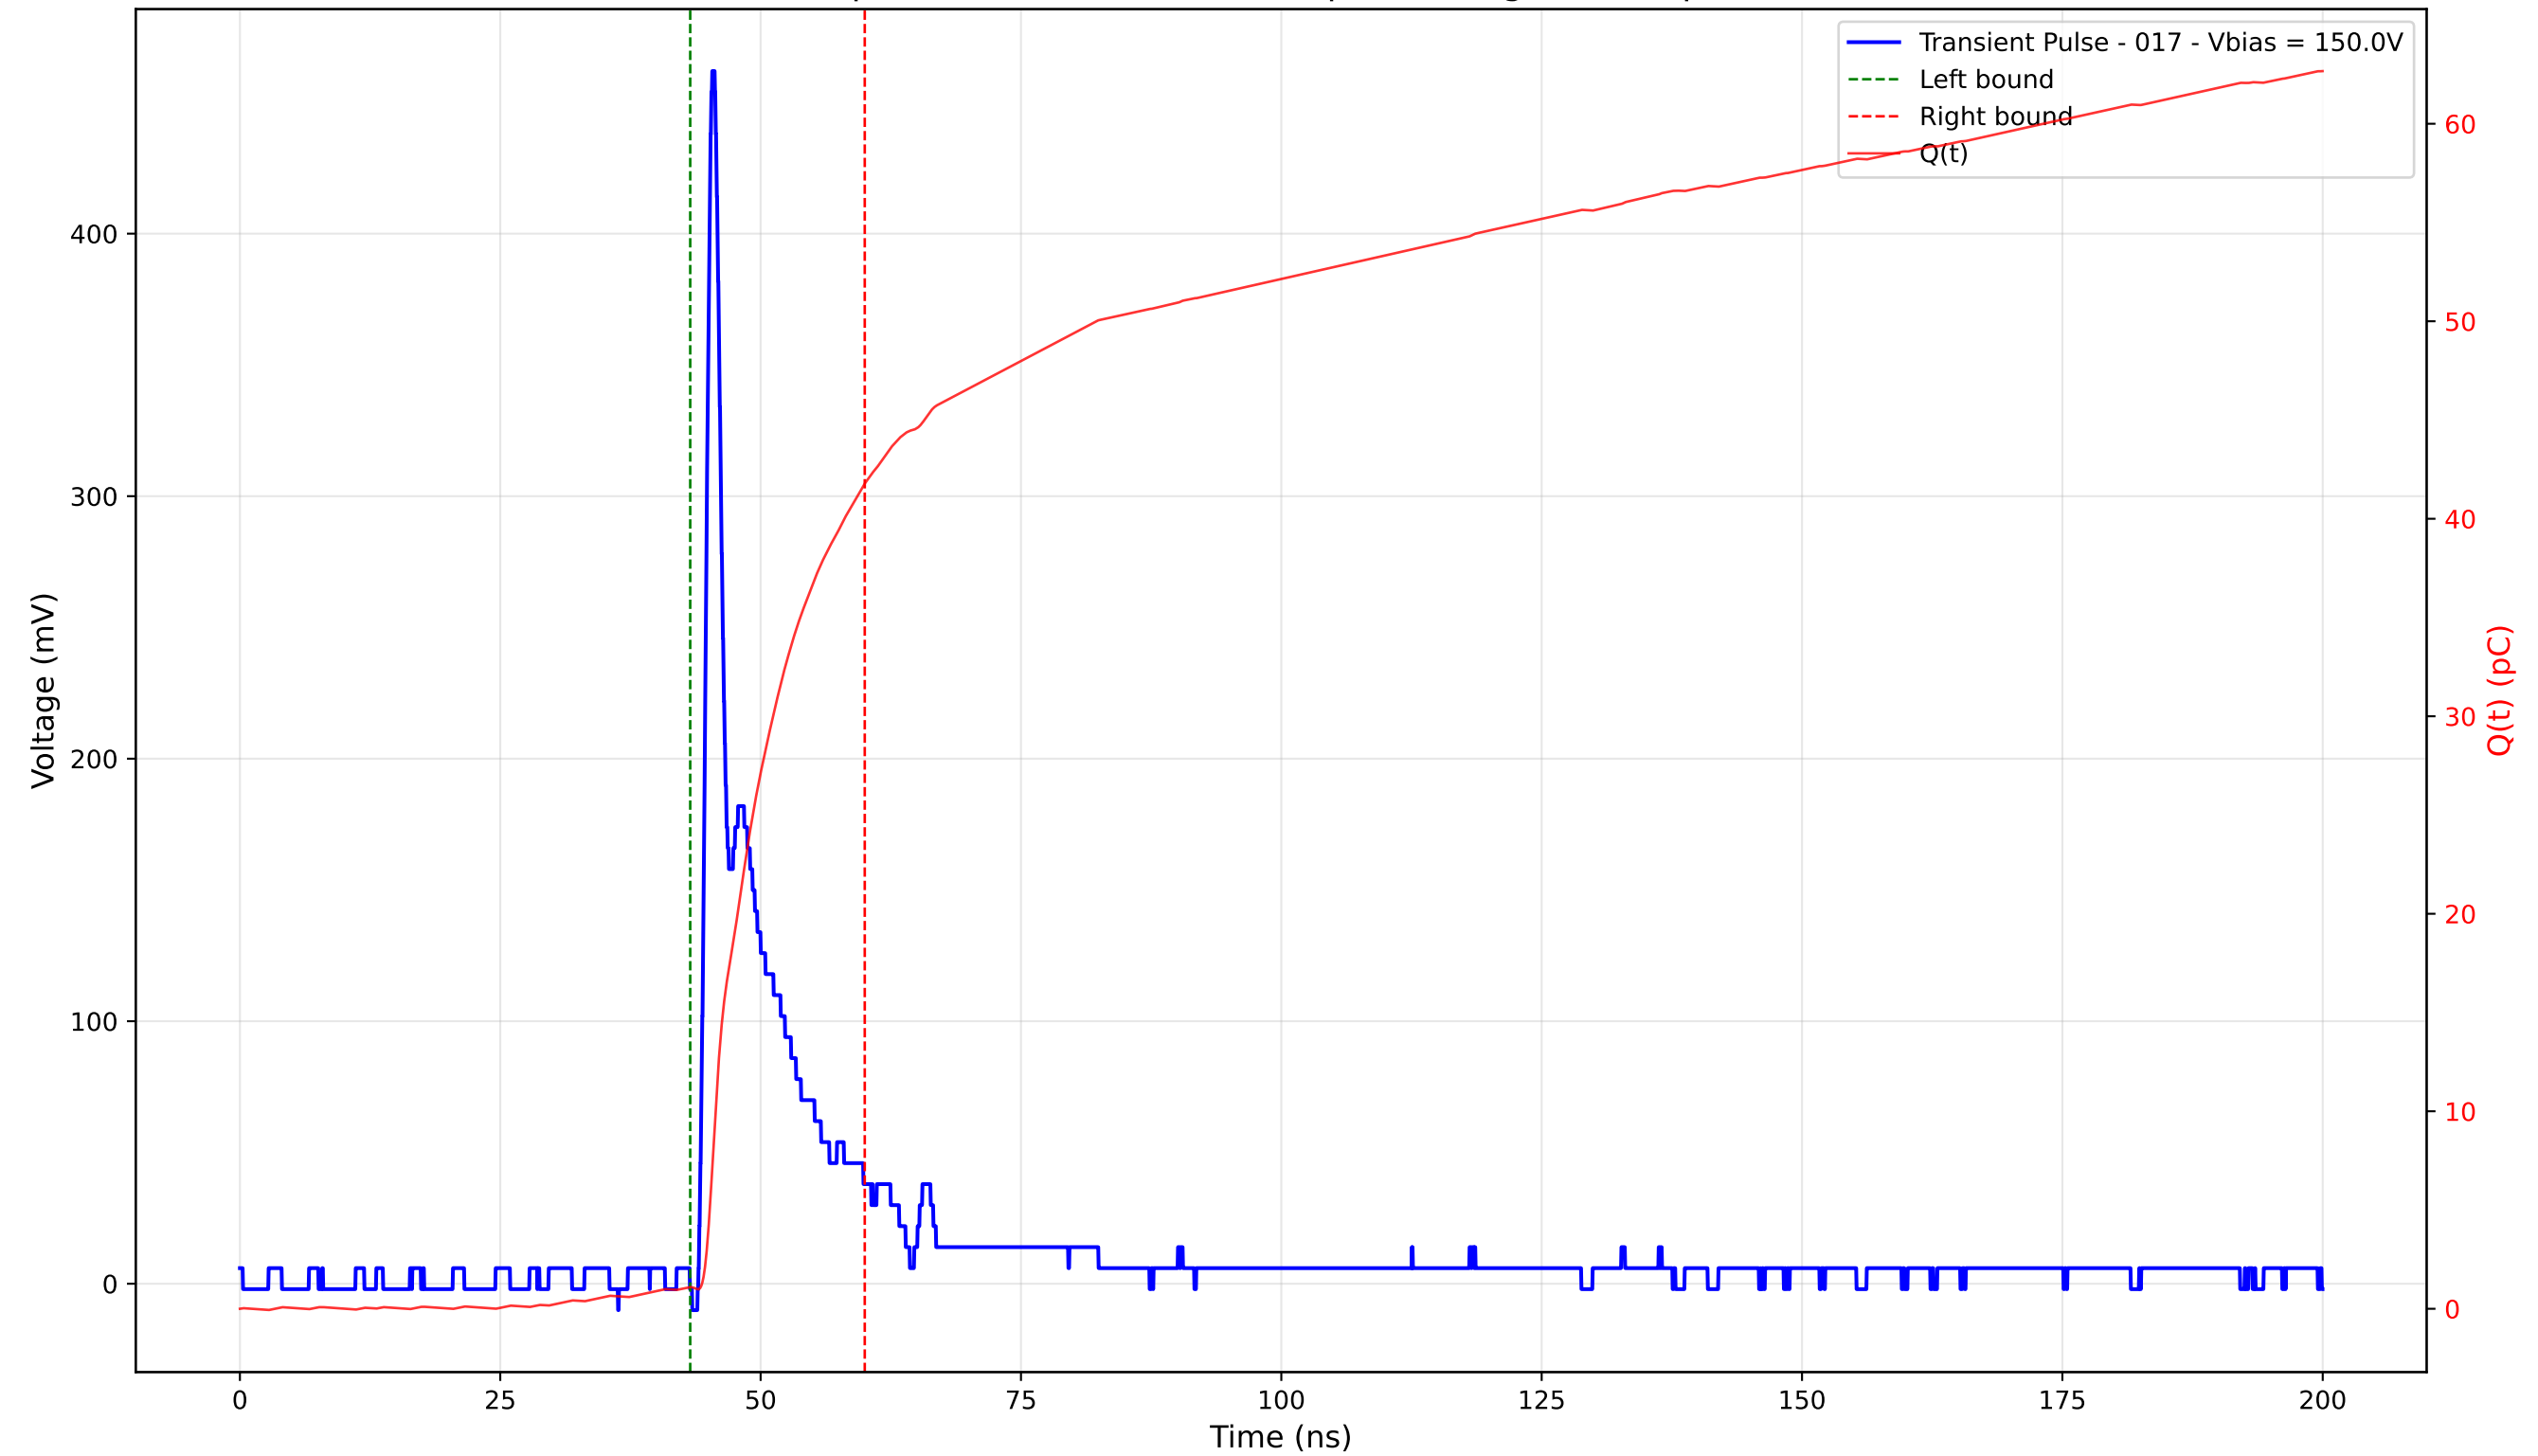


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 39.90 pC - Rise Time: 0.94 ns

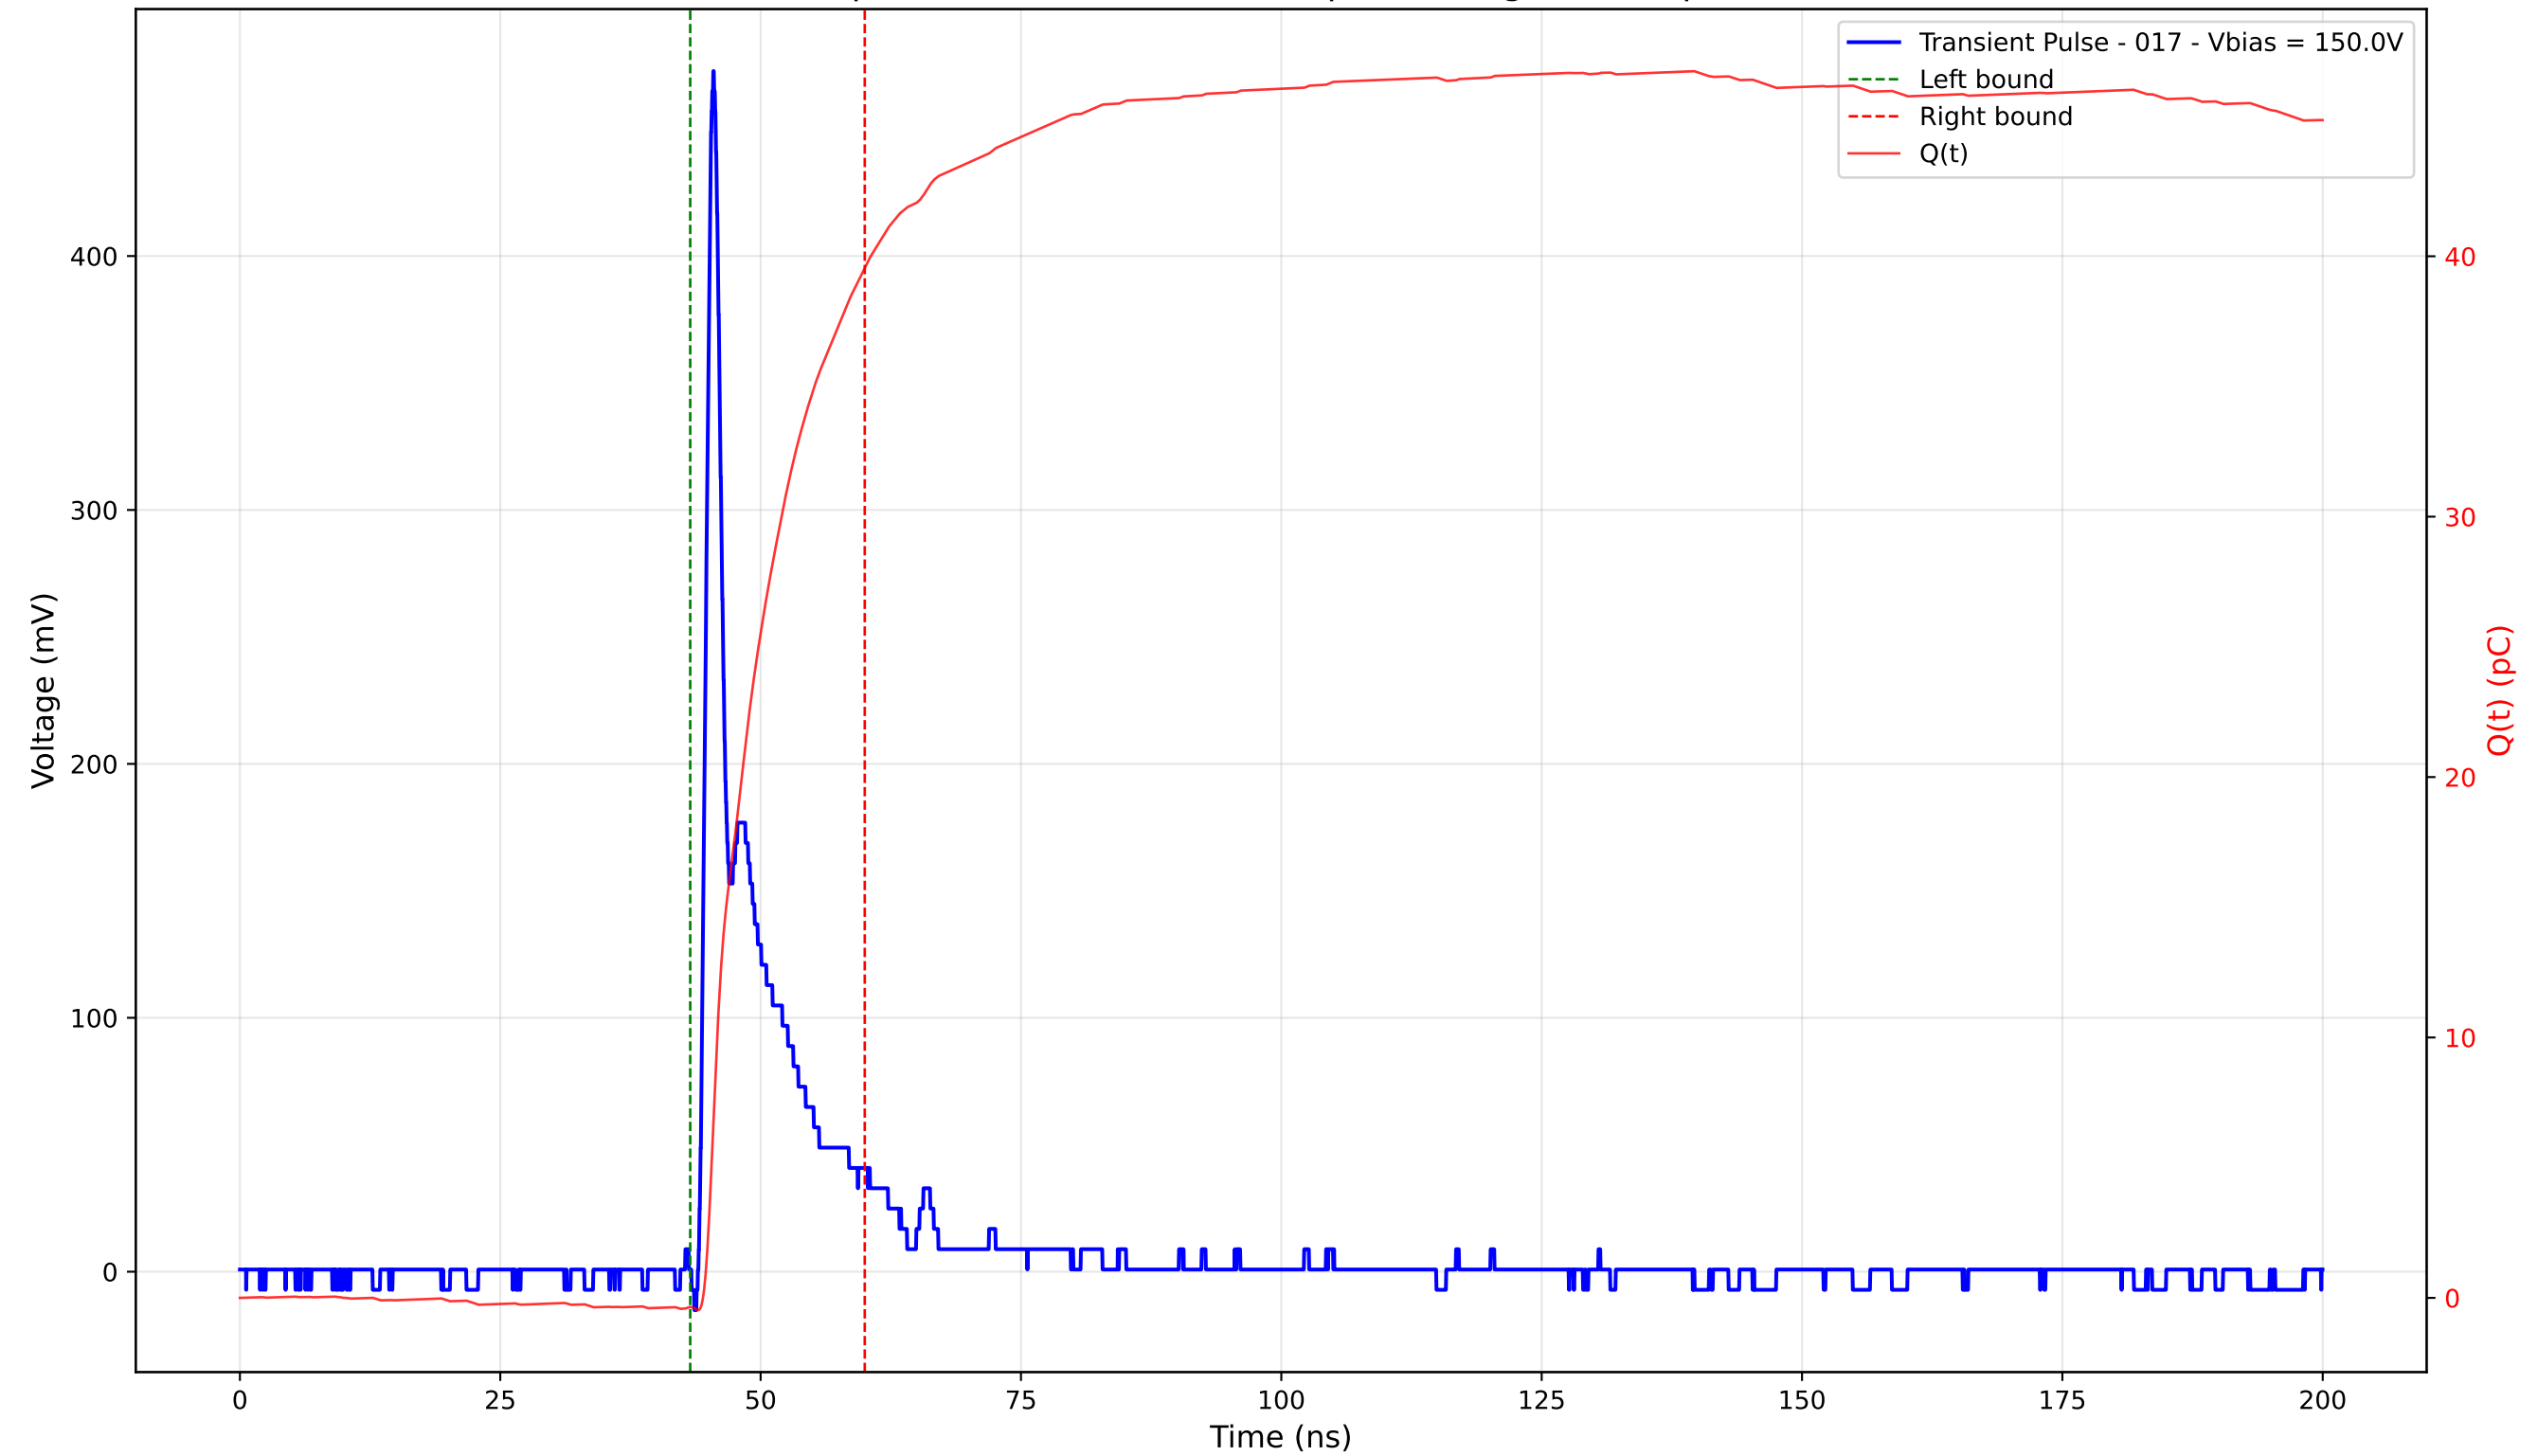


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 40.81 pC - Rise Time: 0.94 ns

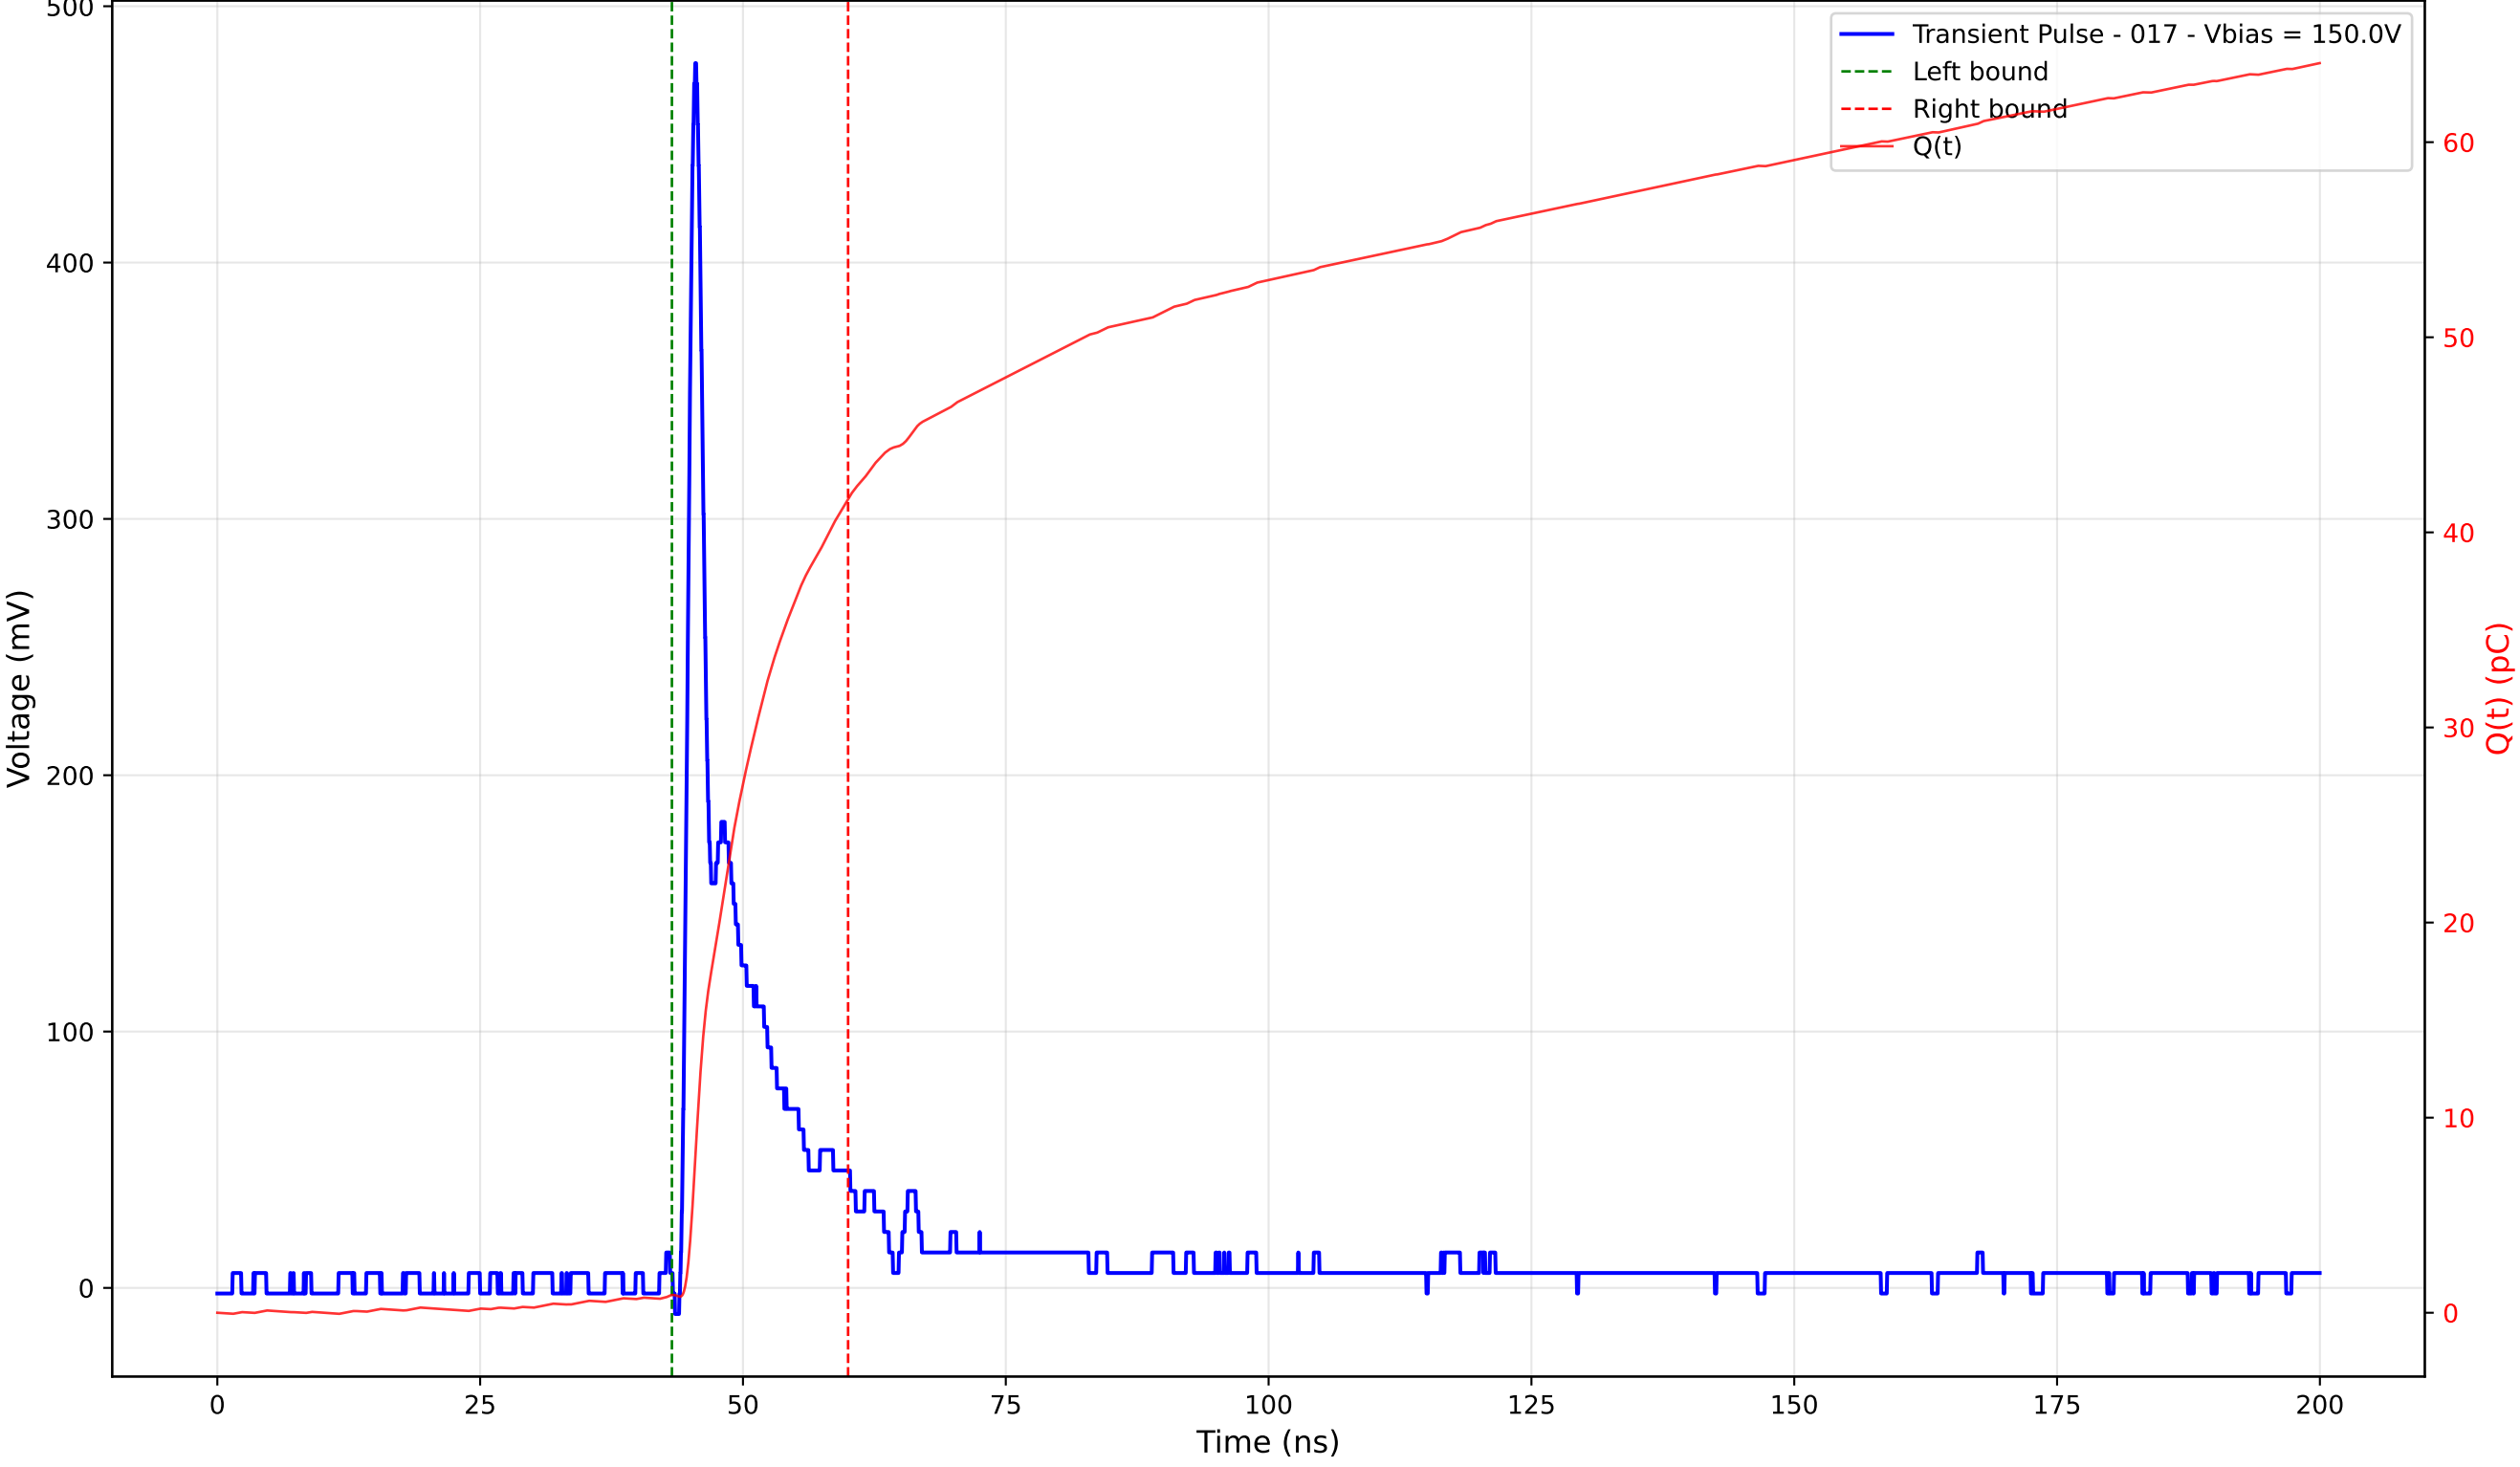


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 40.21 pC - Rise Time: 0.93 ns

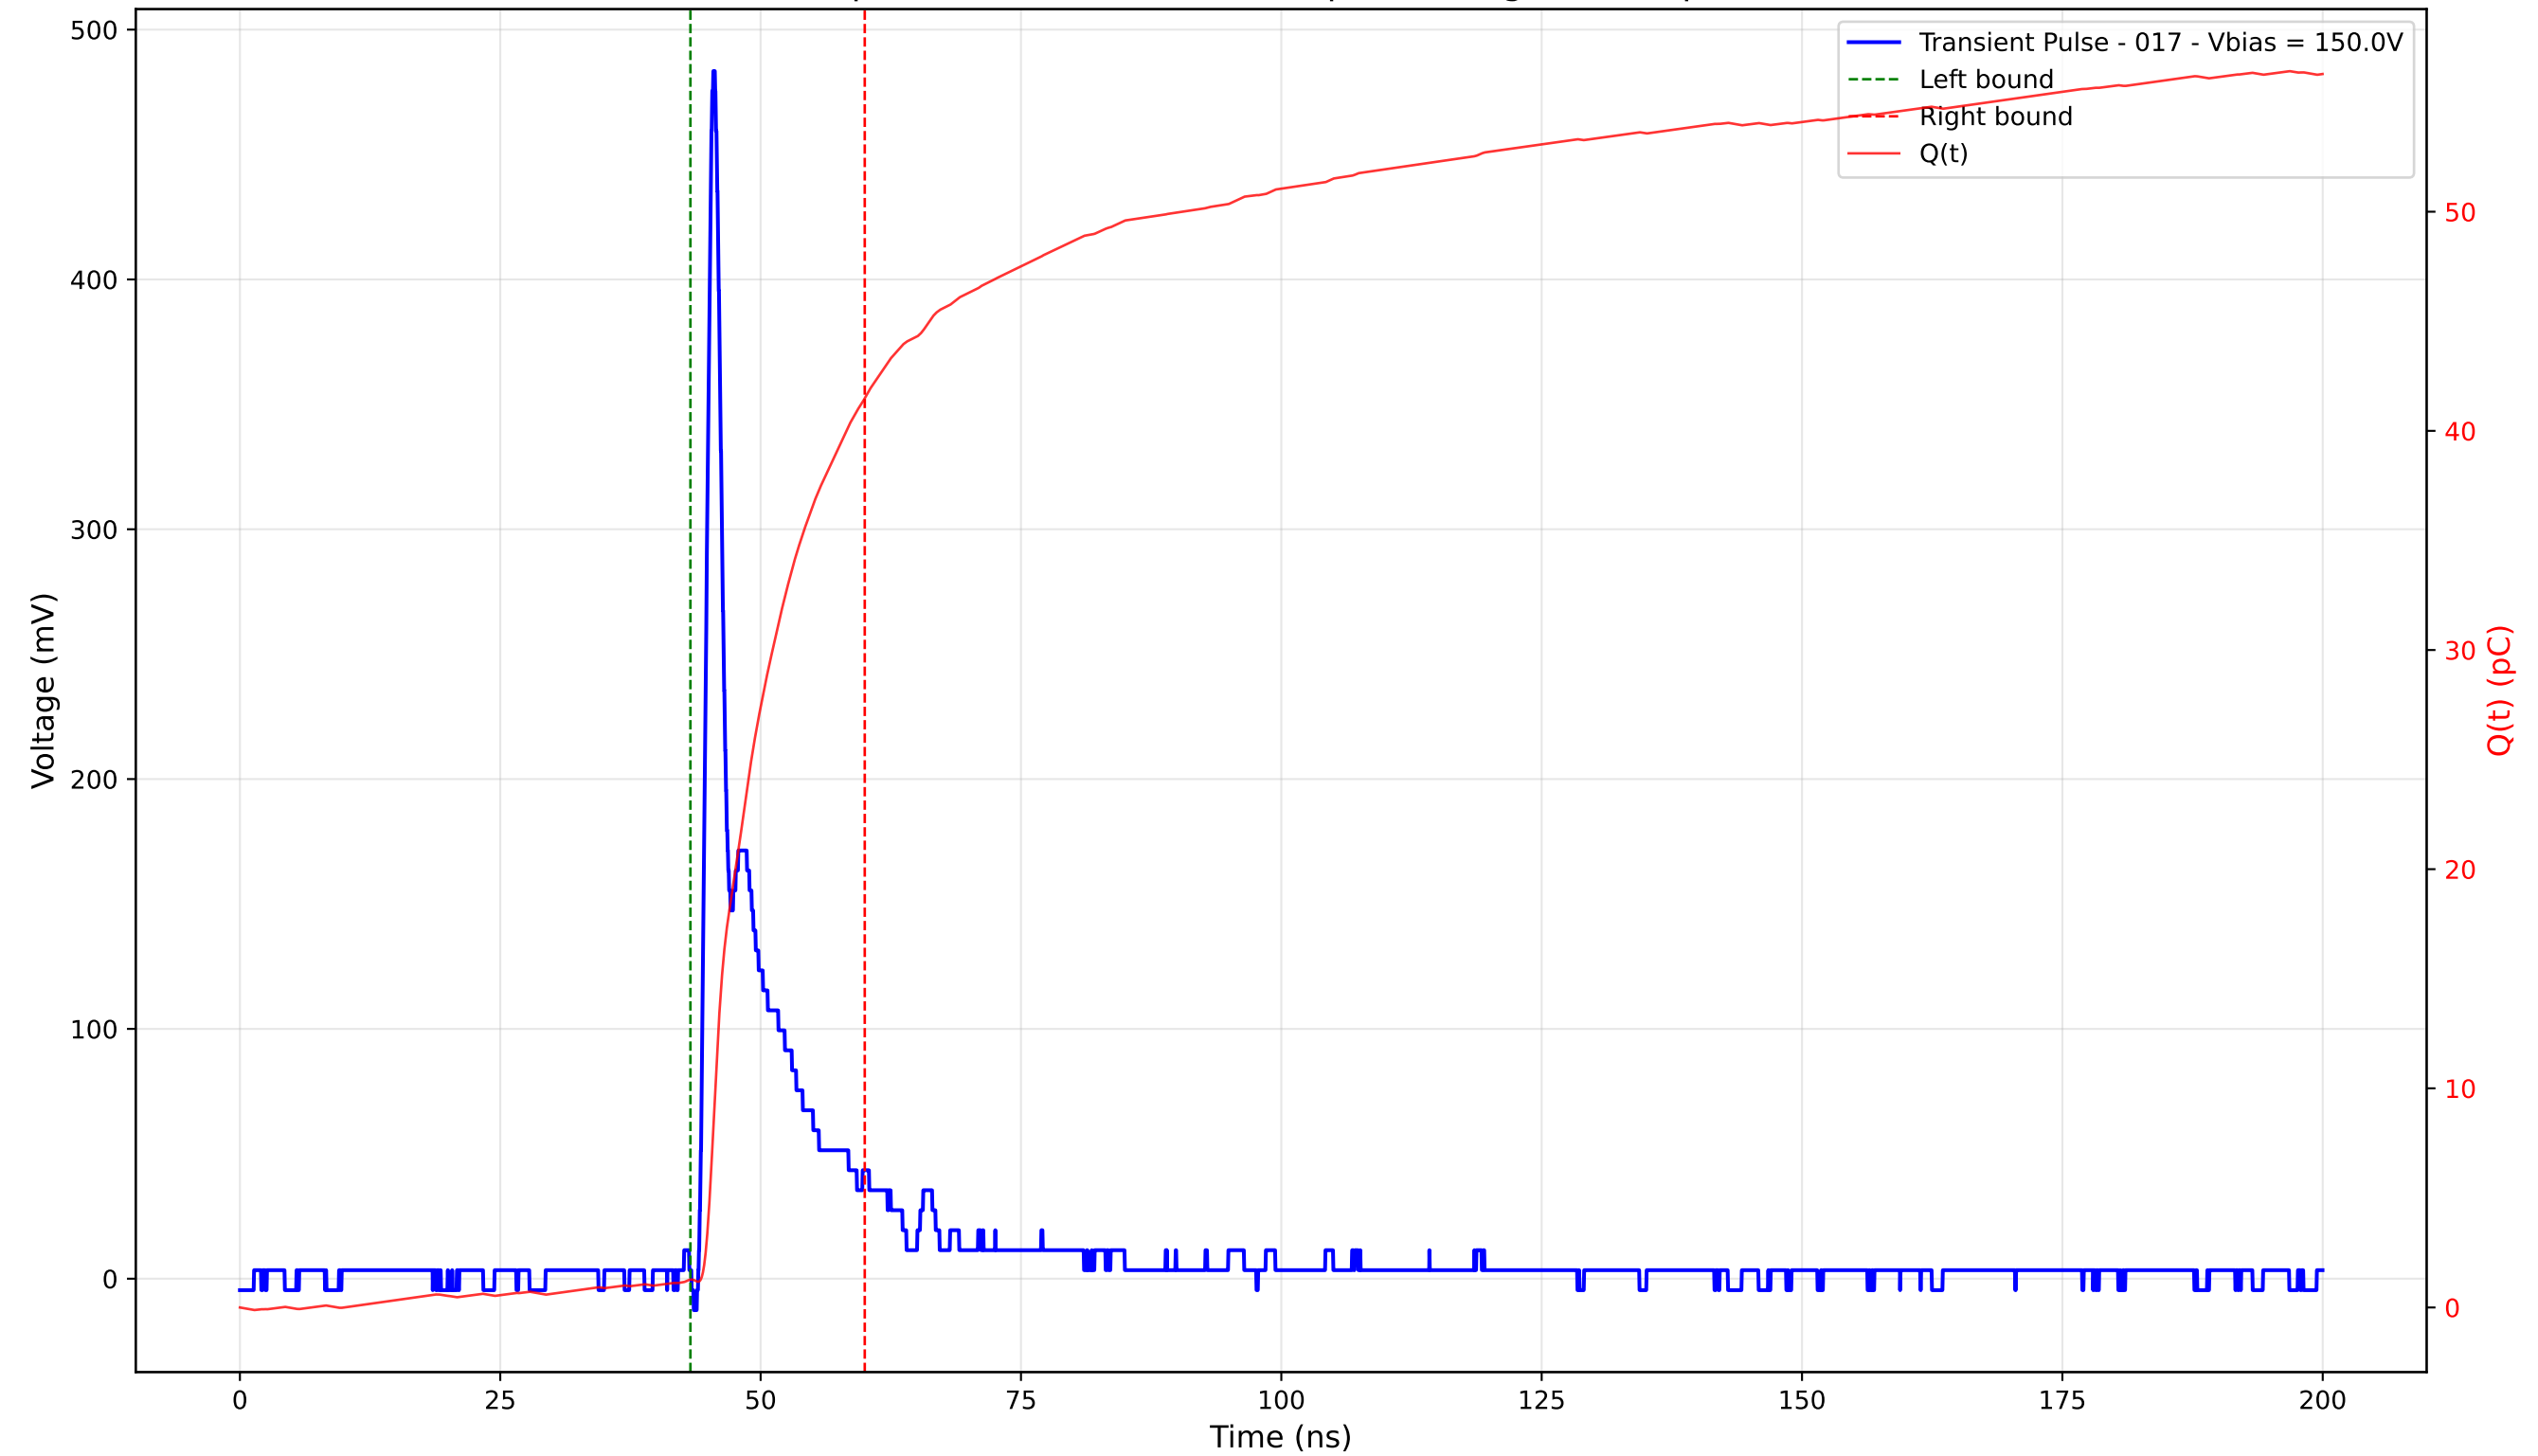


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 39.25 pC - Rise Time: 0.94 ns

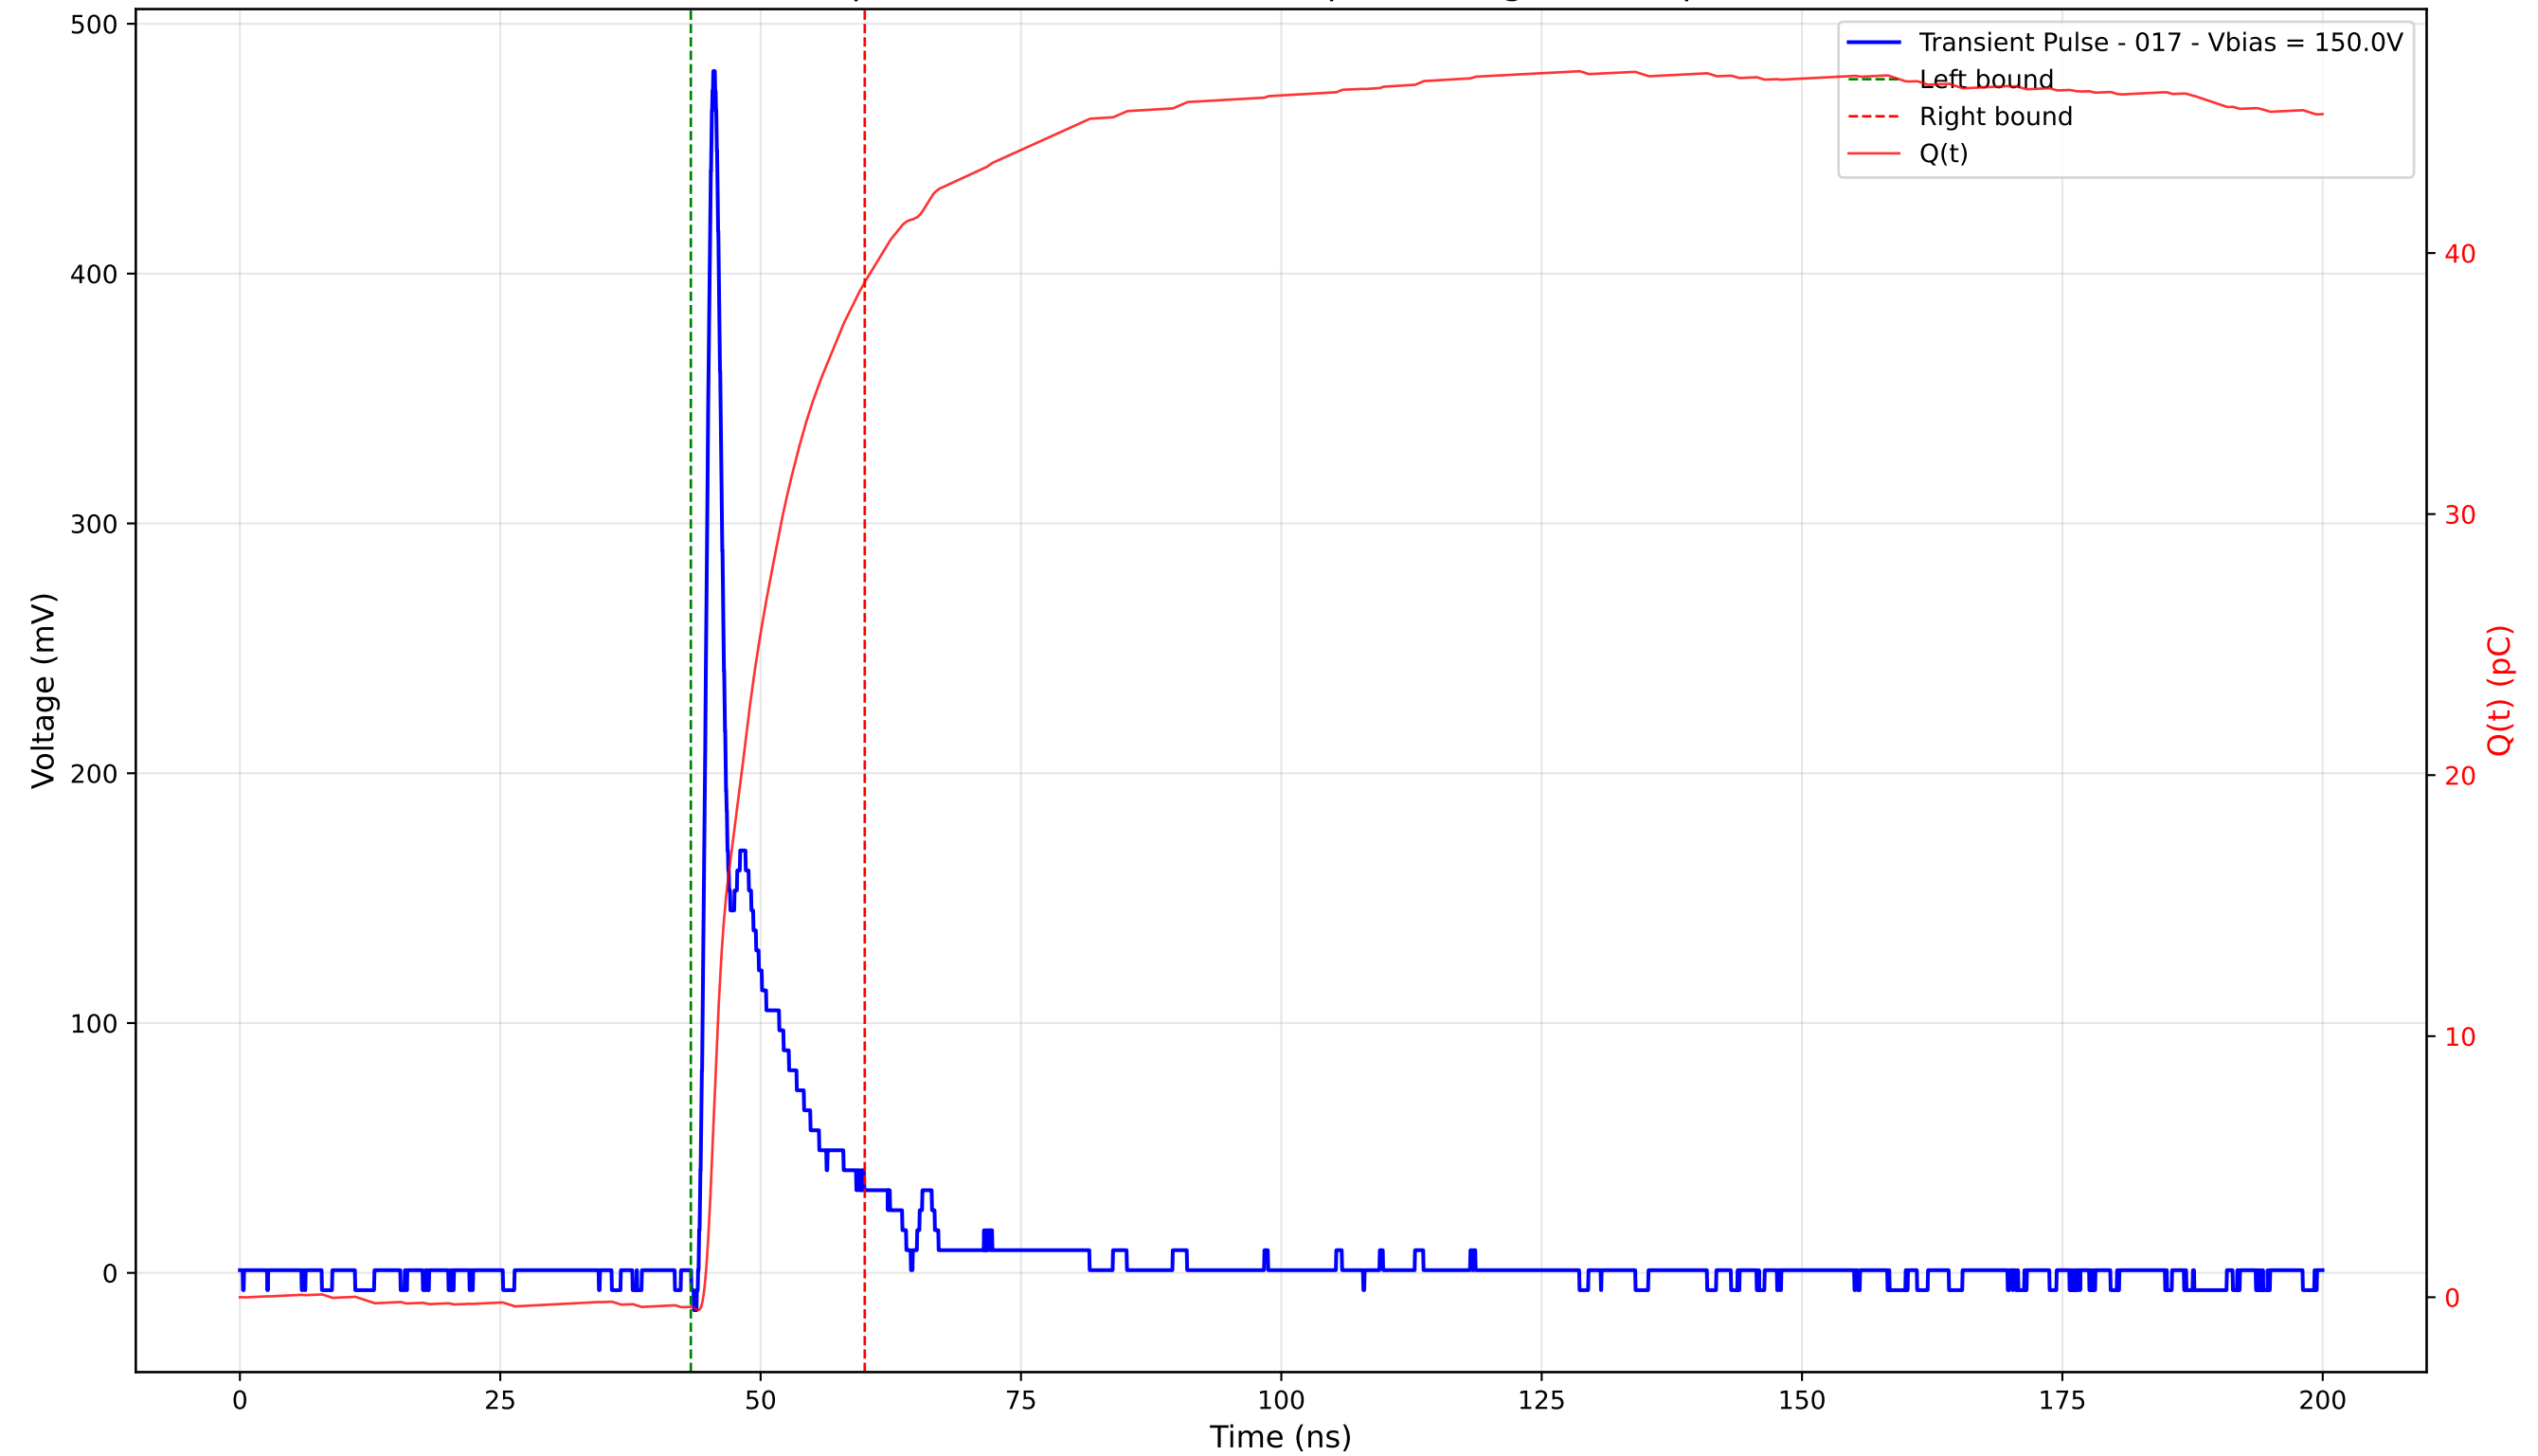


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 39.37 pC - Rise Time: 0.95 ns

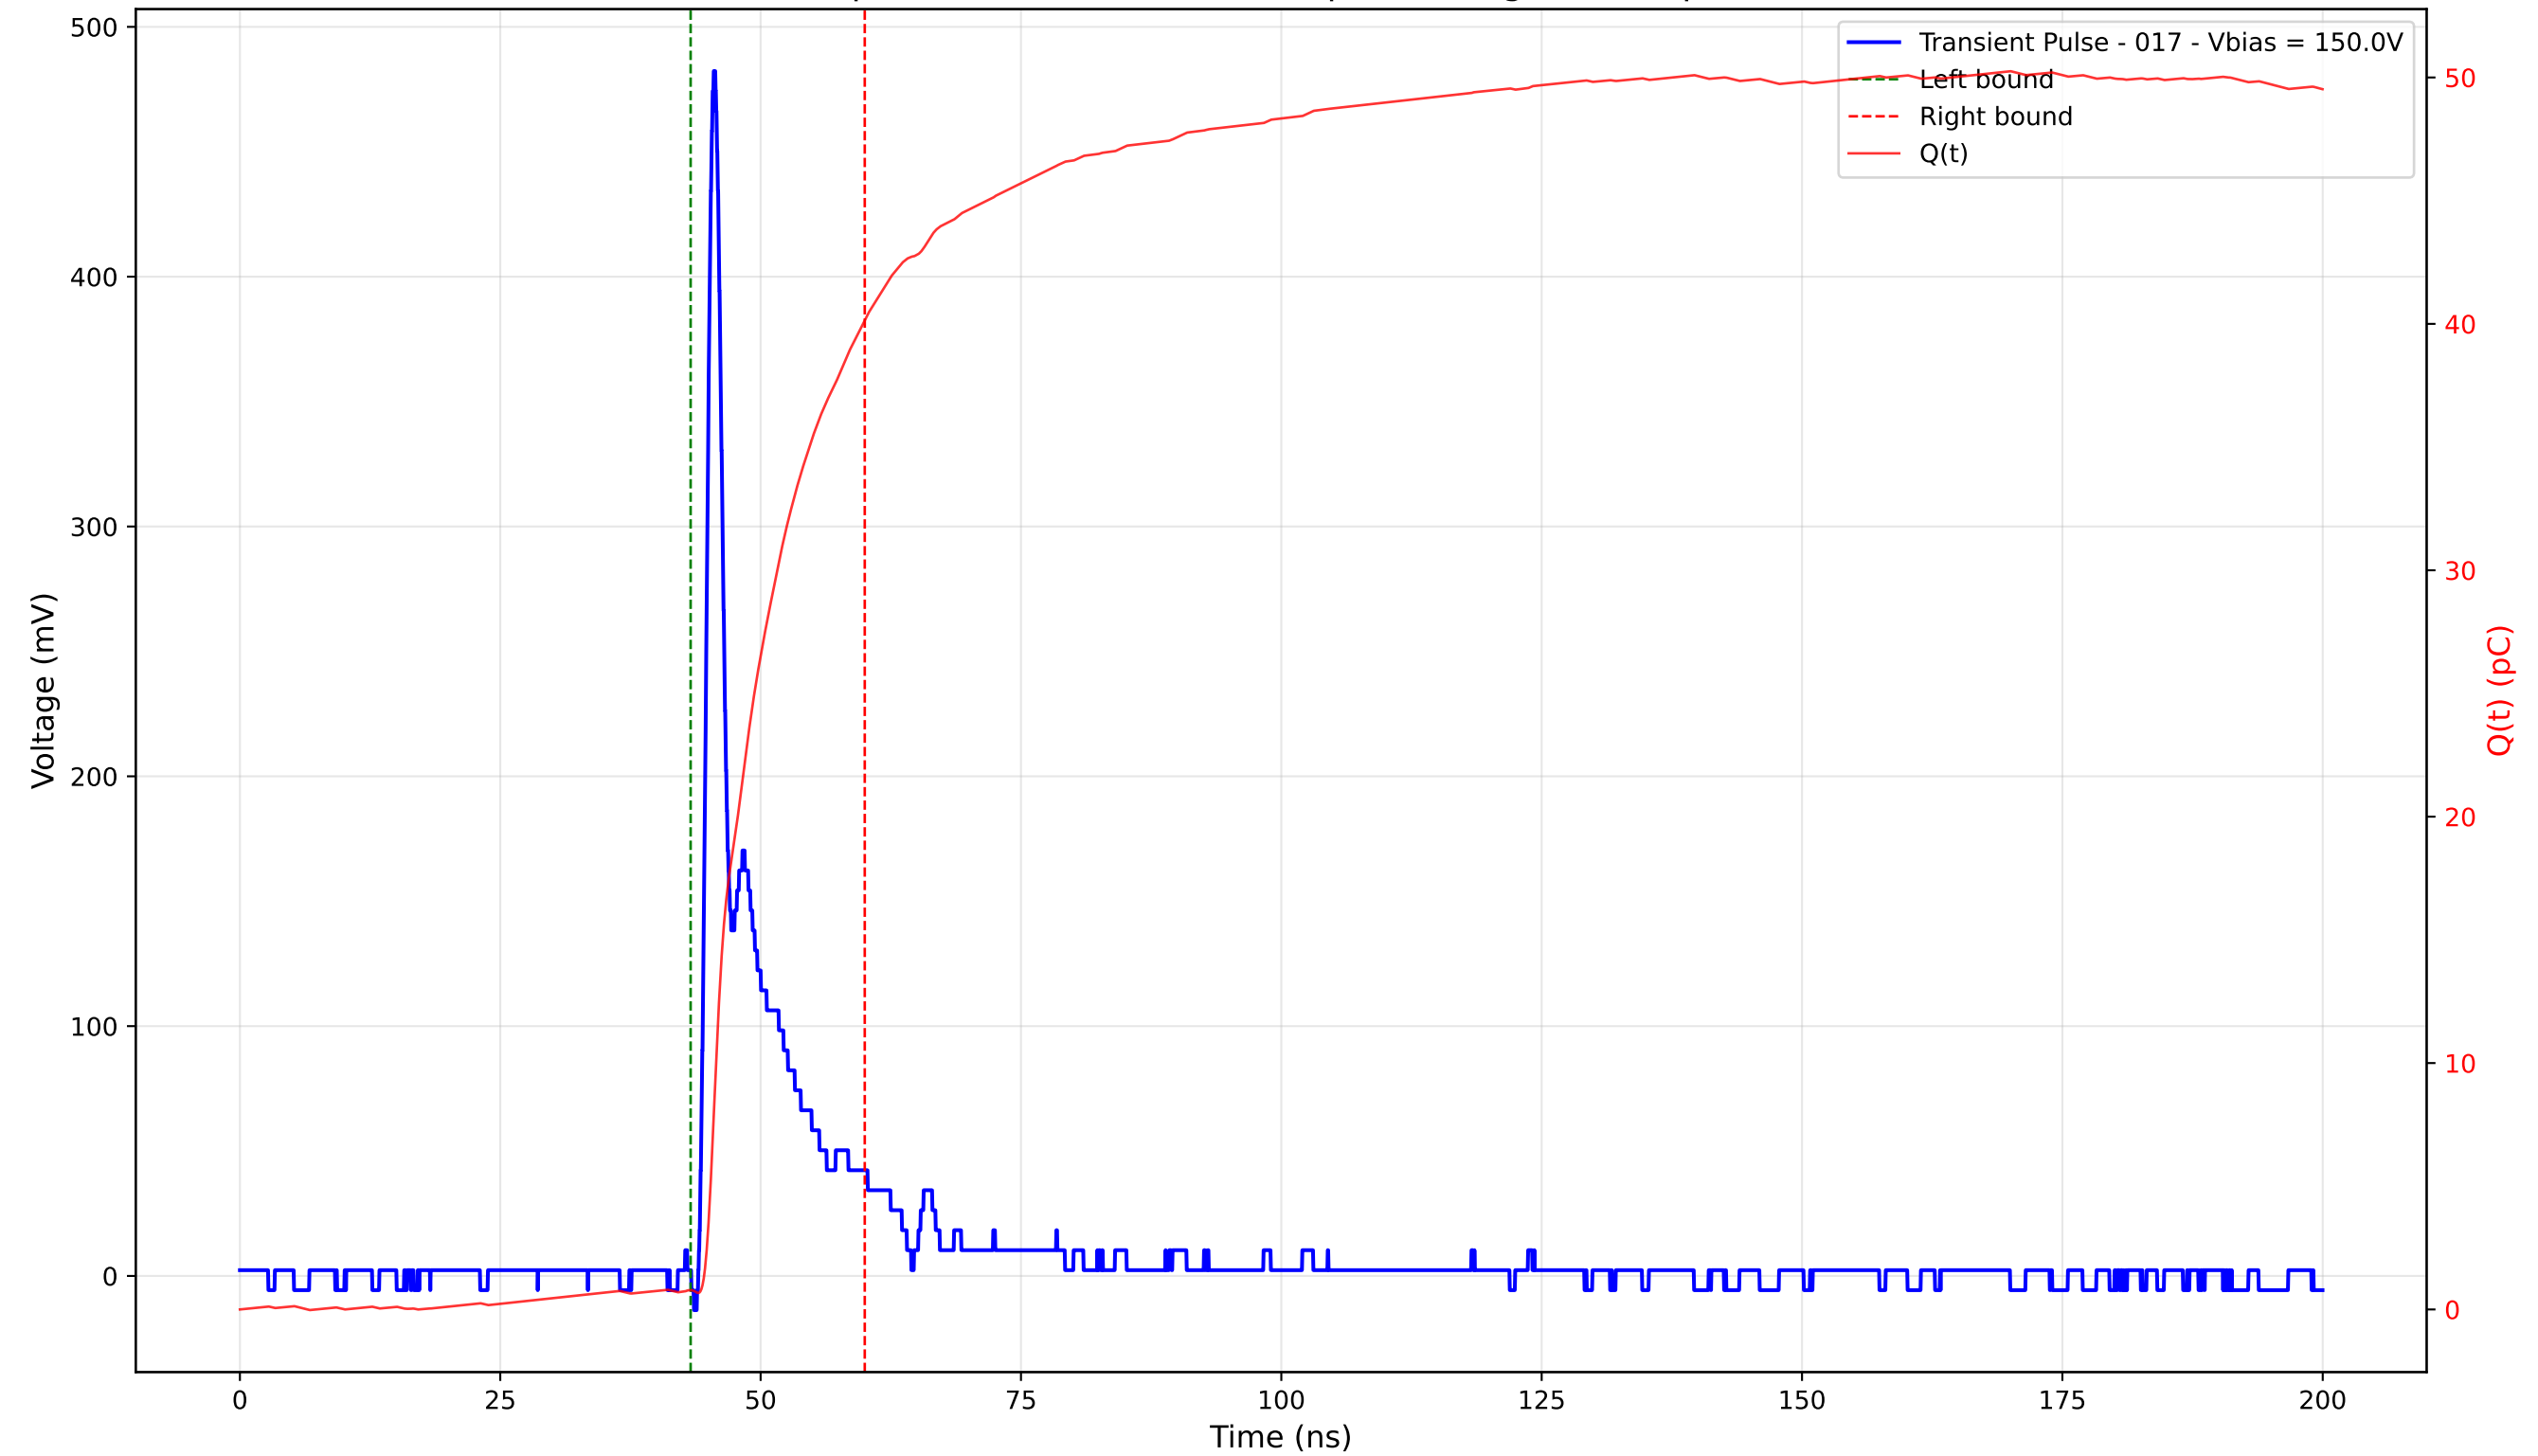


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 39.90 pC - Rise Time: 0.97 ns

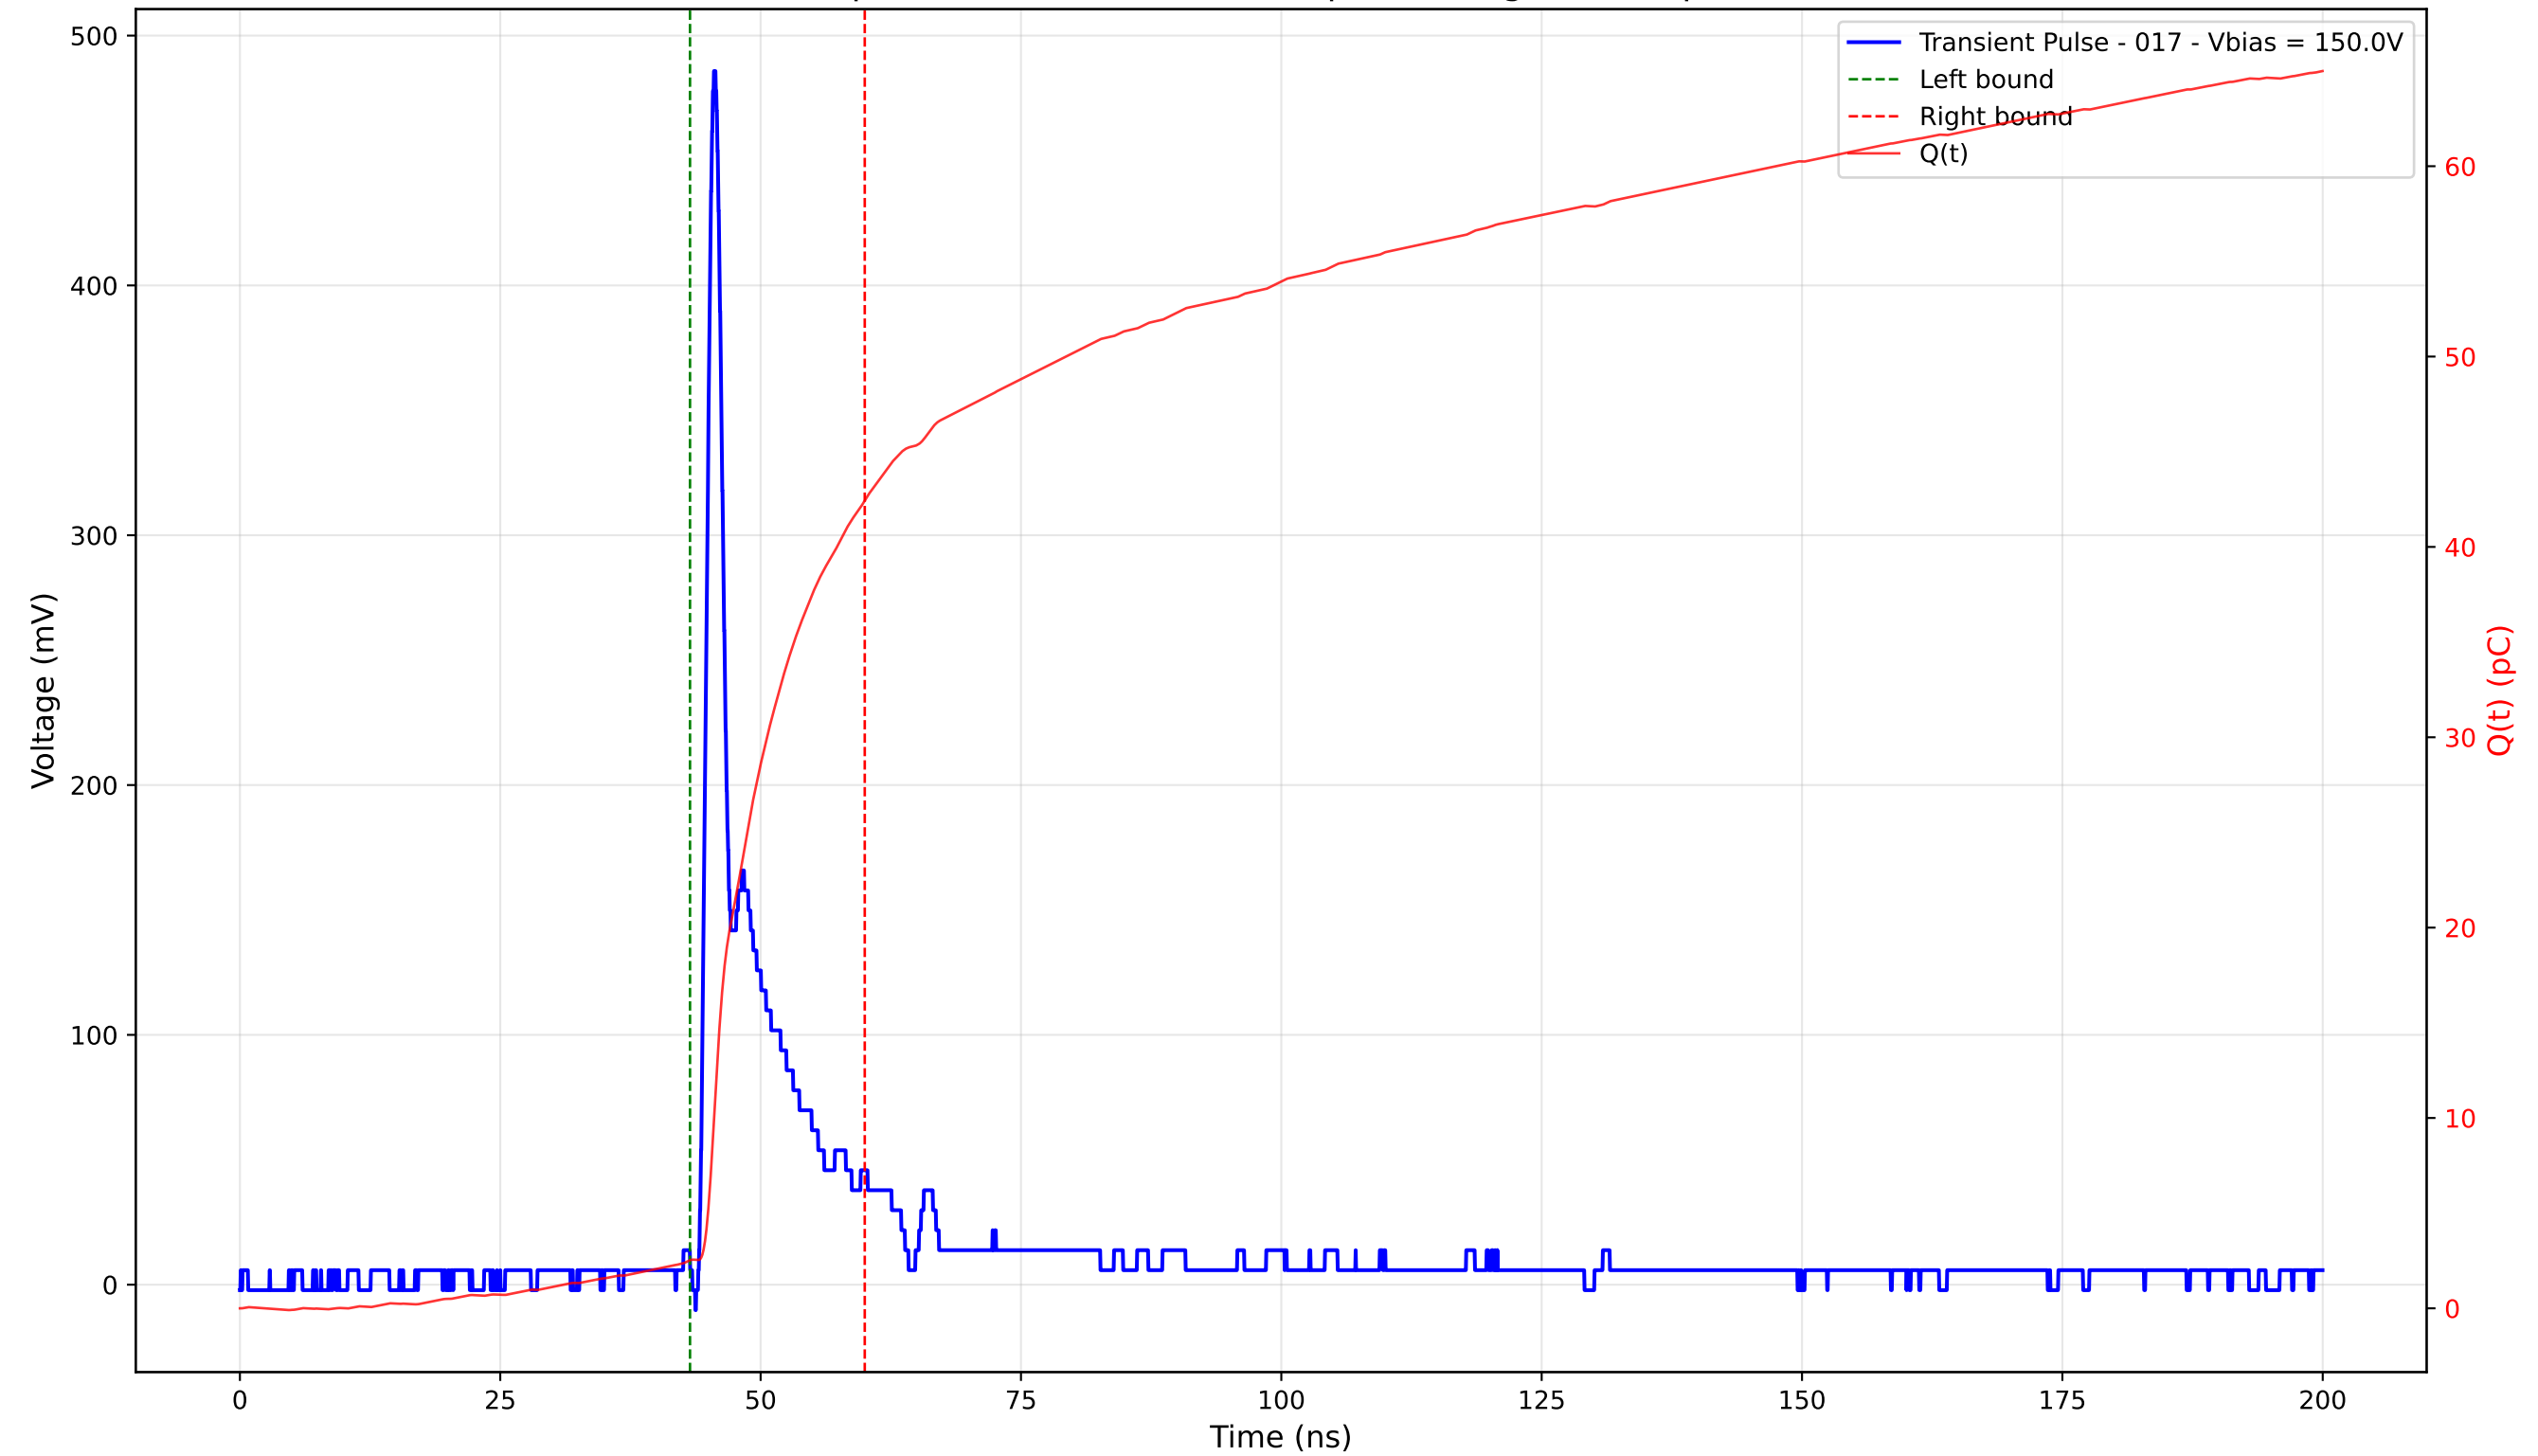


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 39.22 pC - Rise Time: 0.99 ns

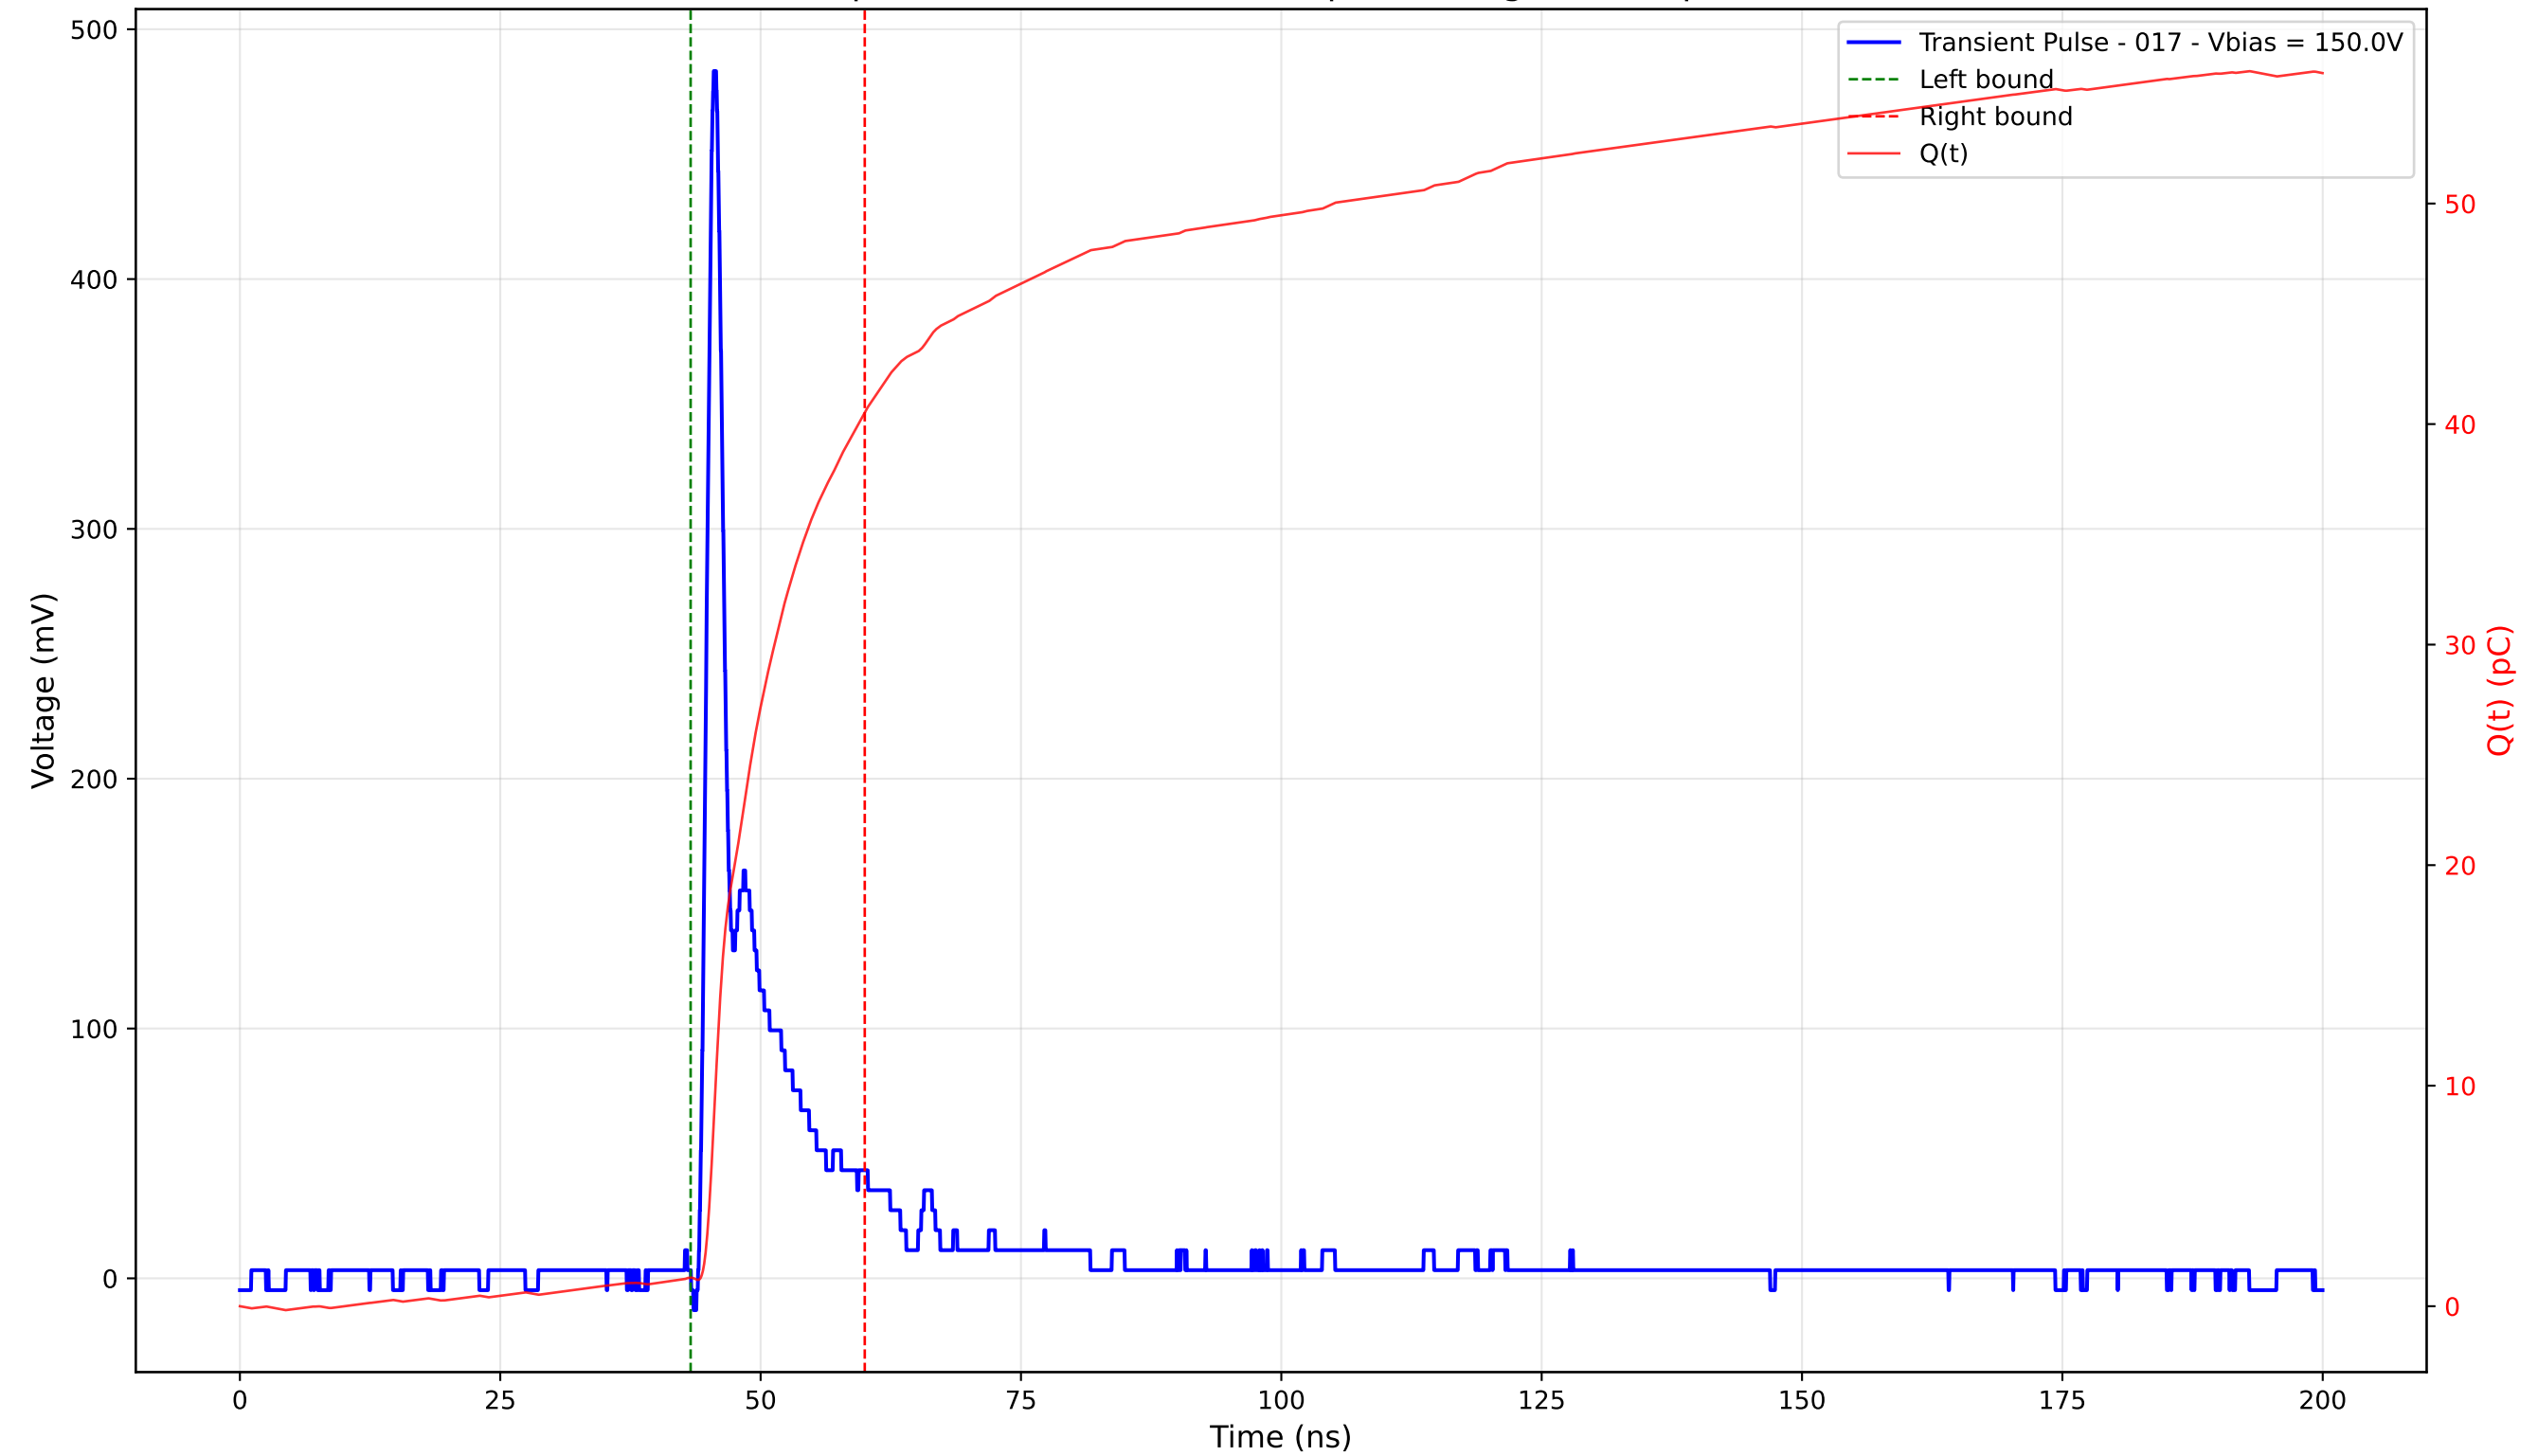


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 38.30 pC - Rise Time: 1.00 ns

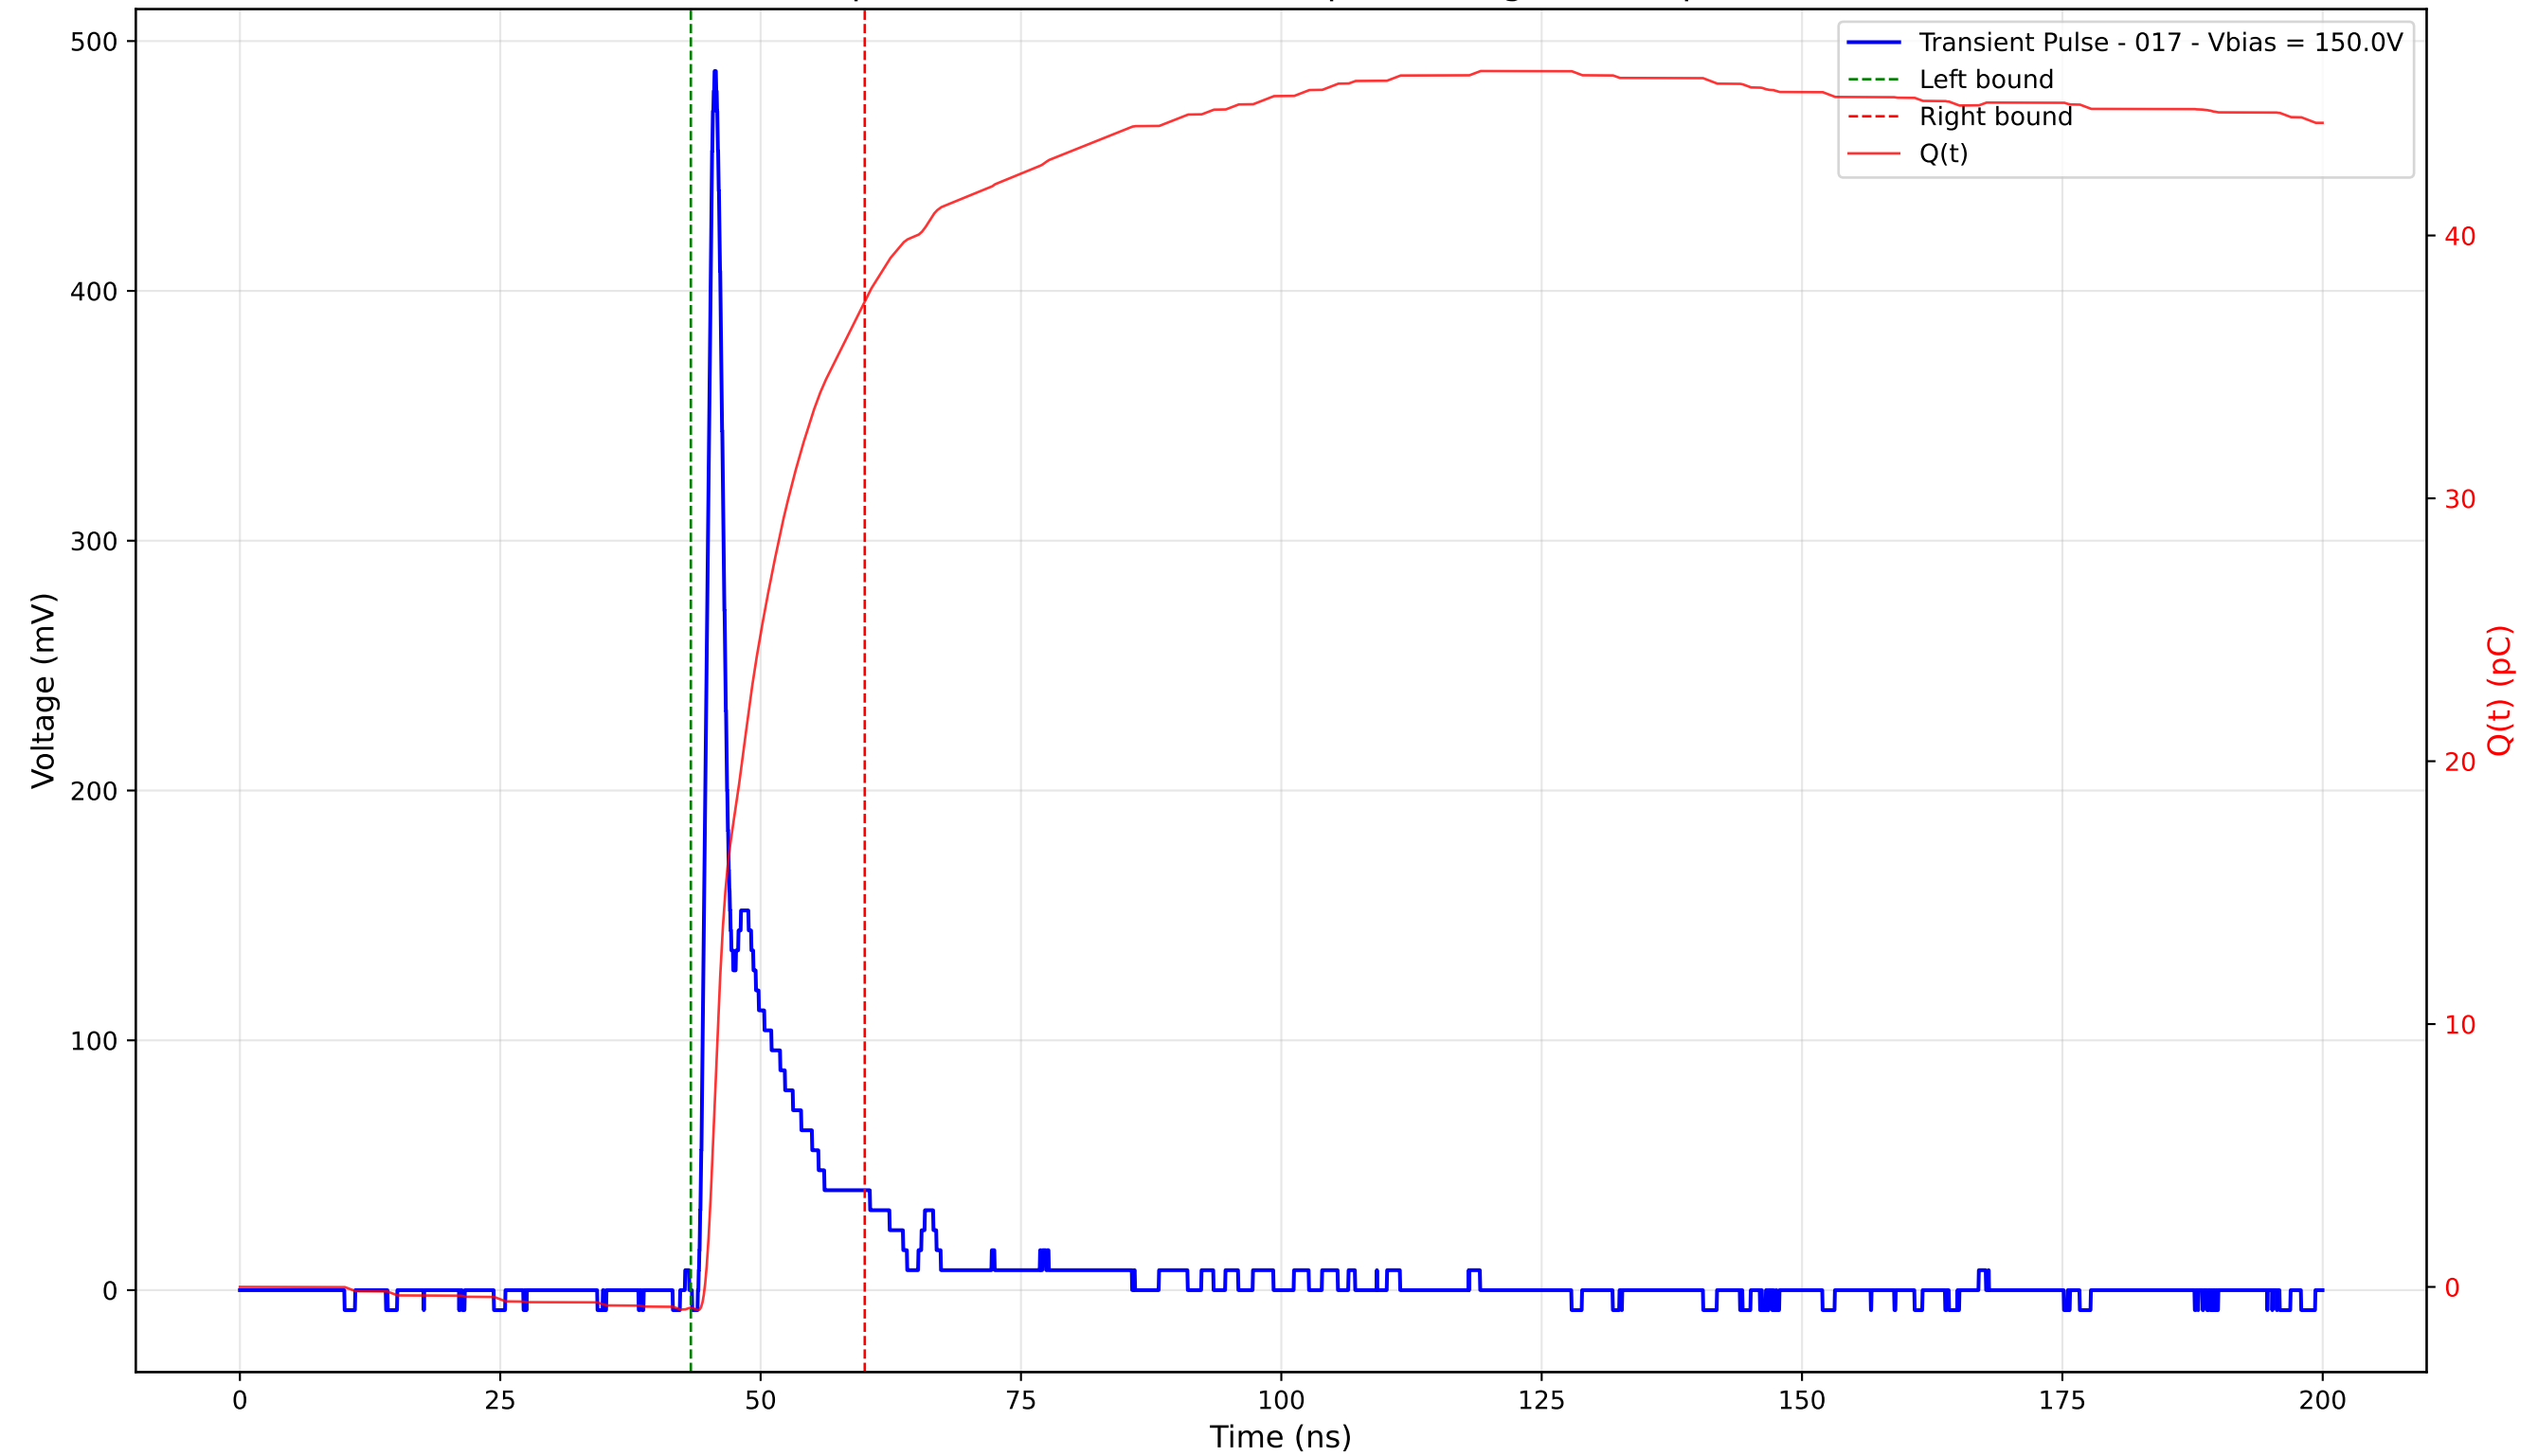


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 37.64 pC - Rise Time: 1.02 ns

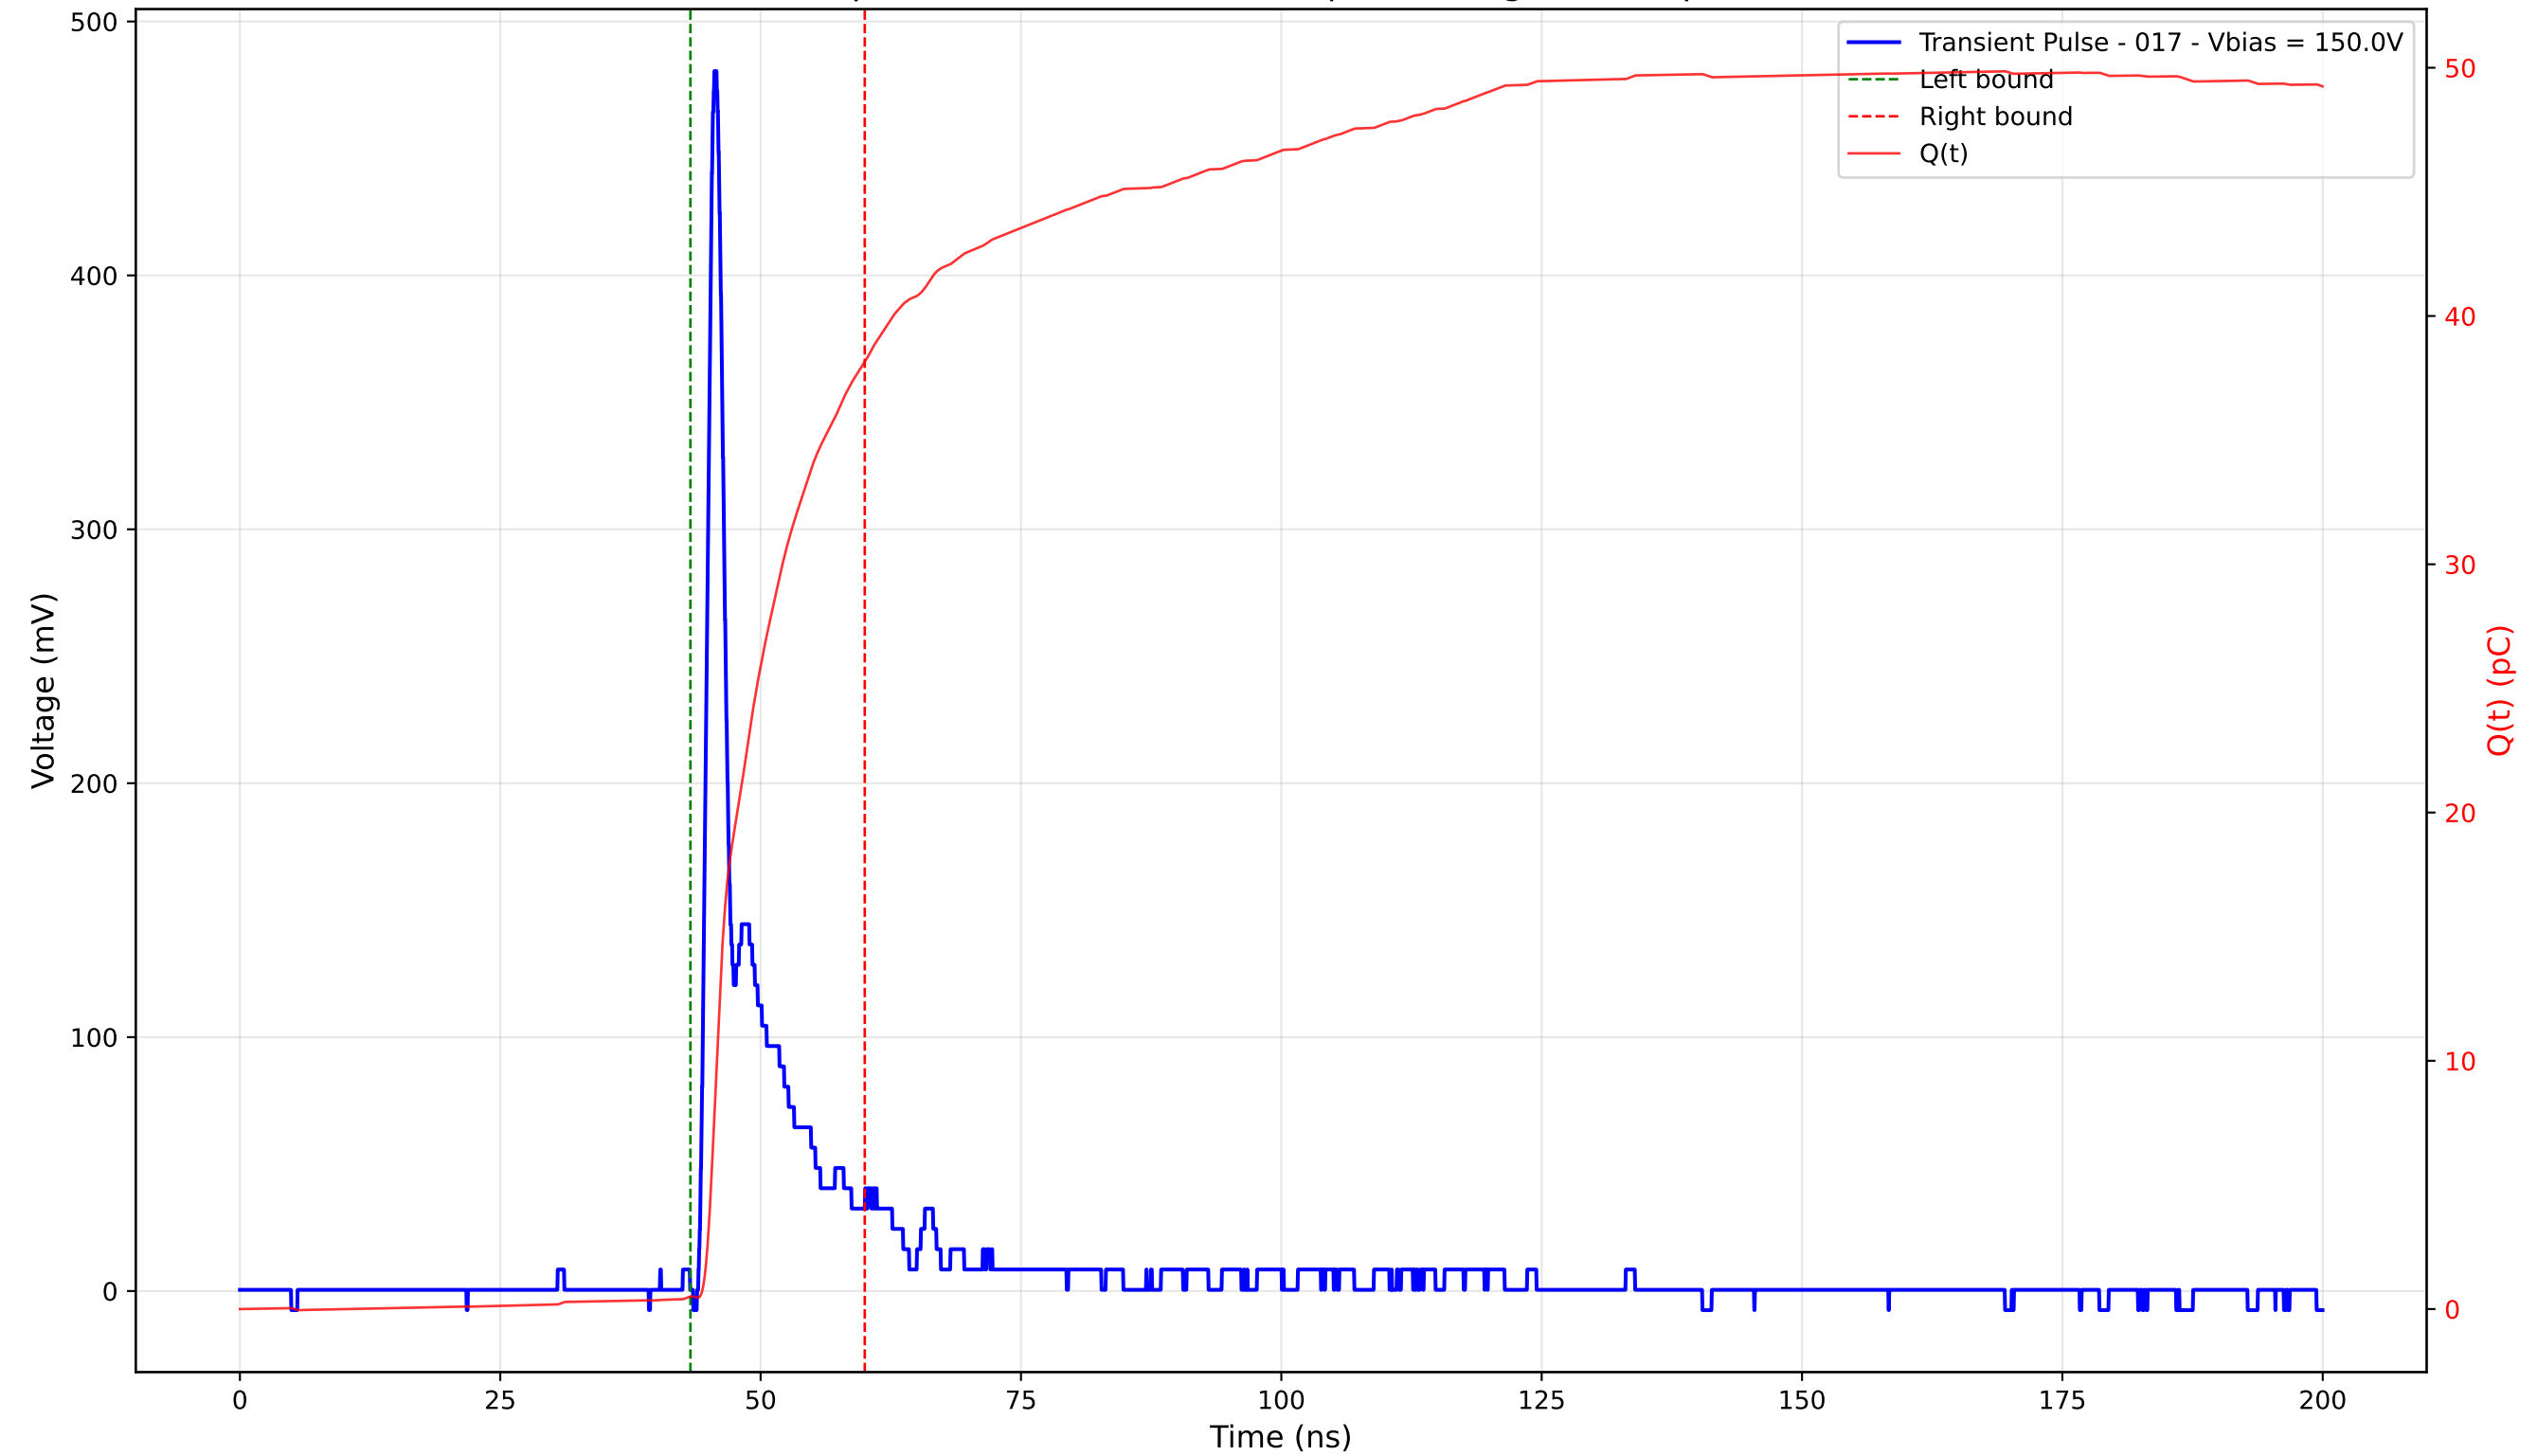


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 37.49 pC - Rise Time: 1.04 ns

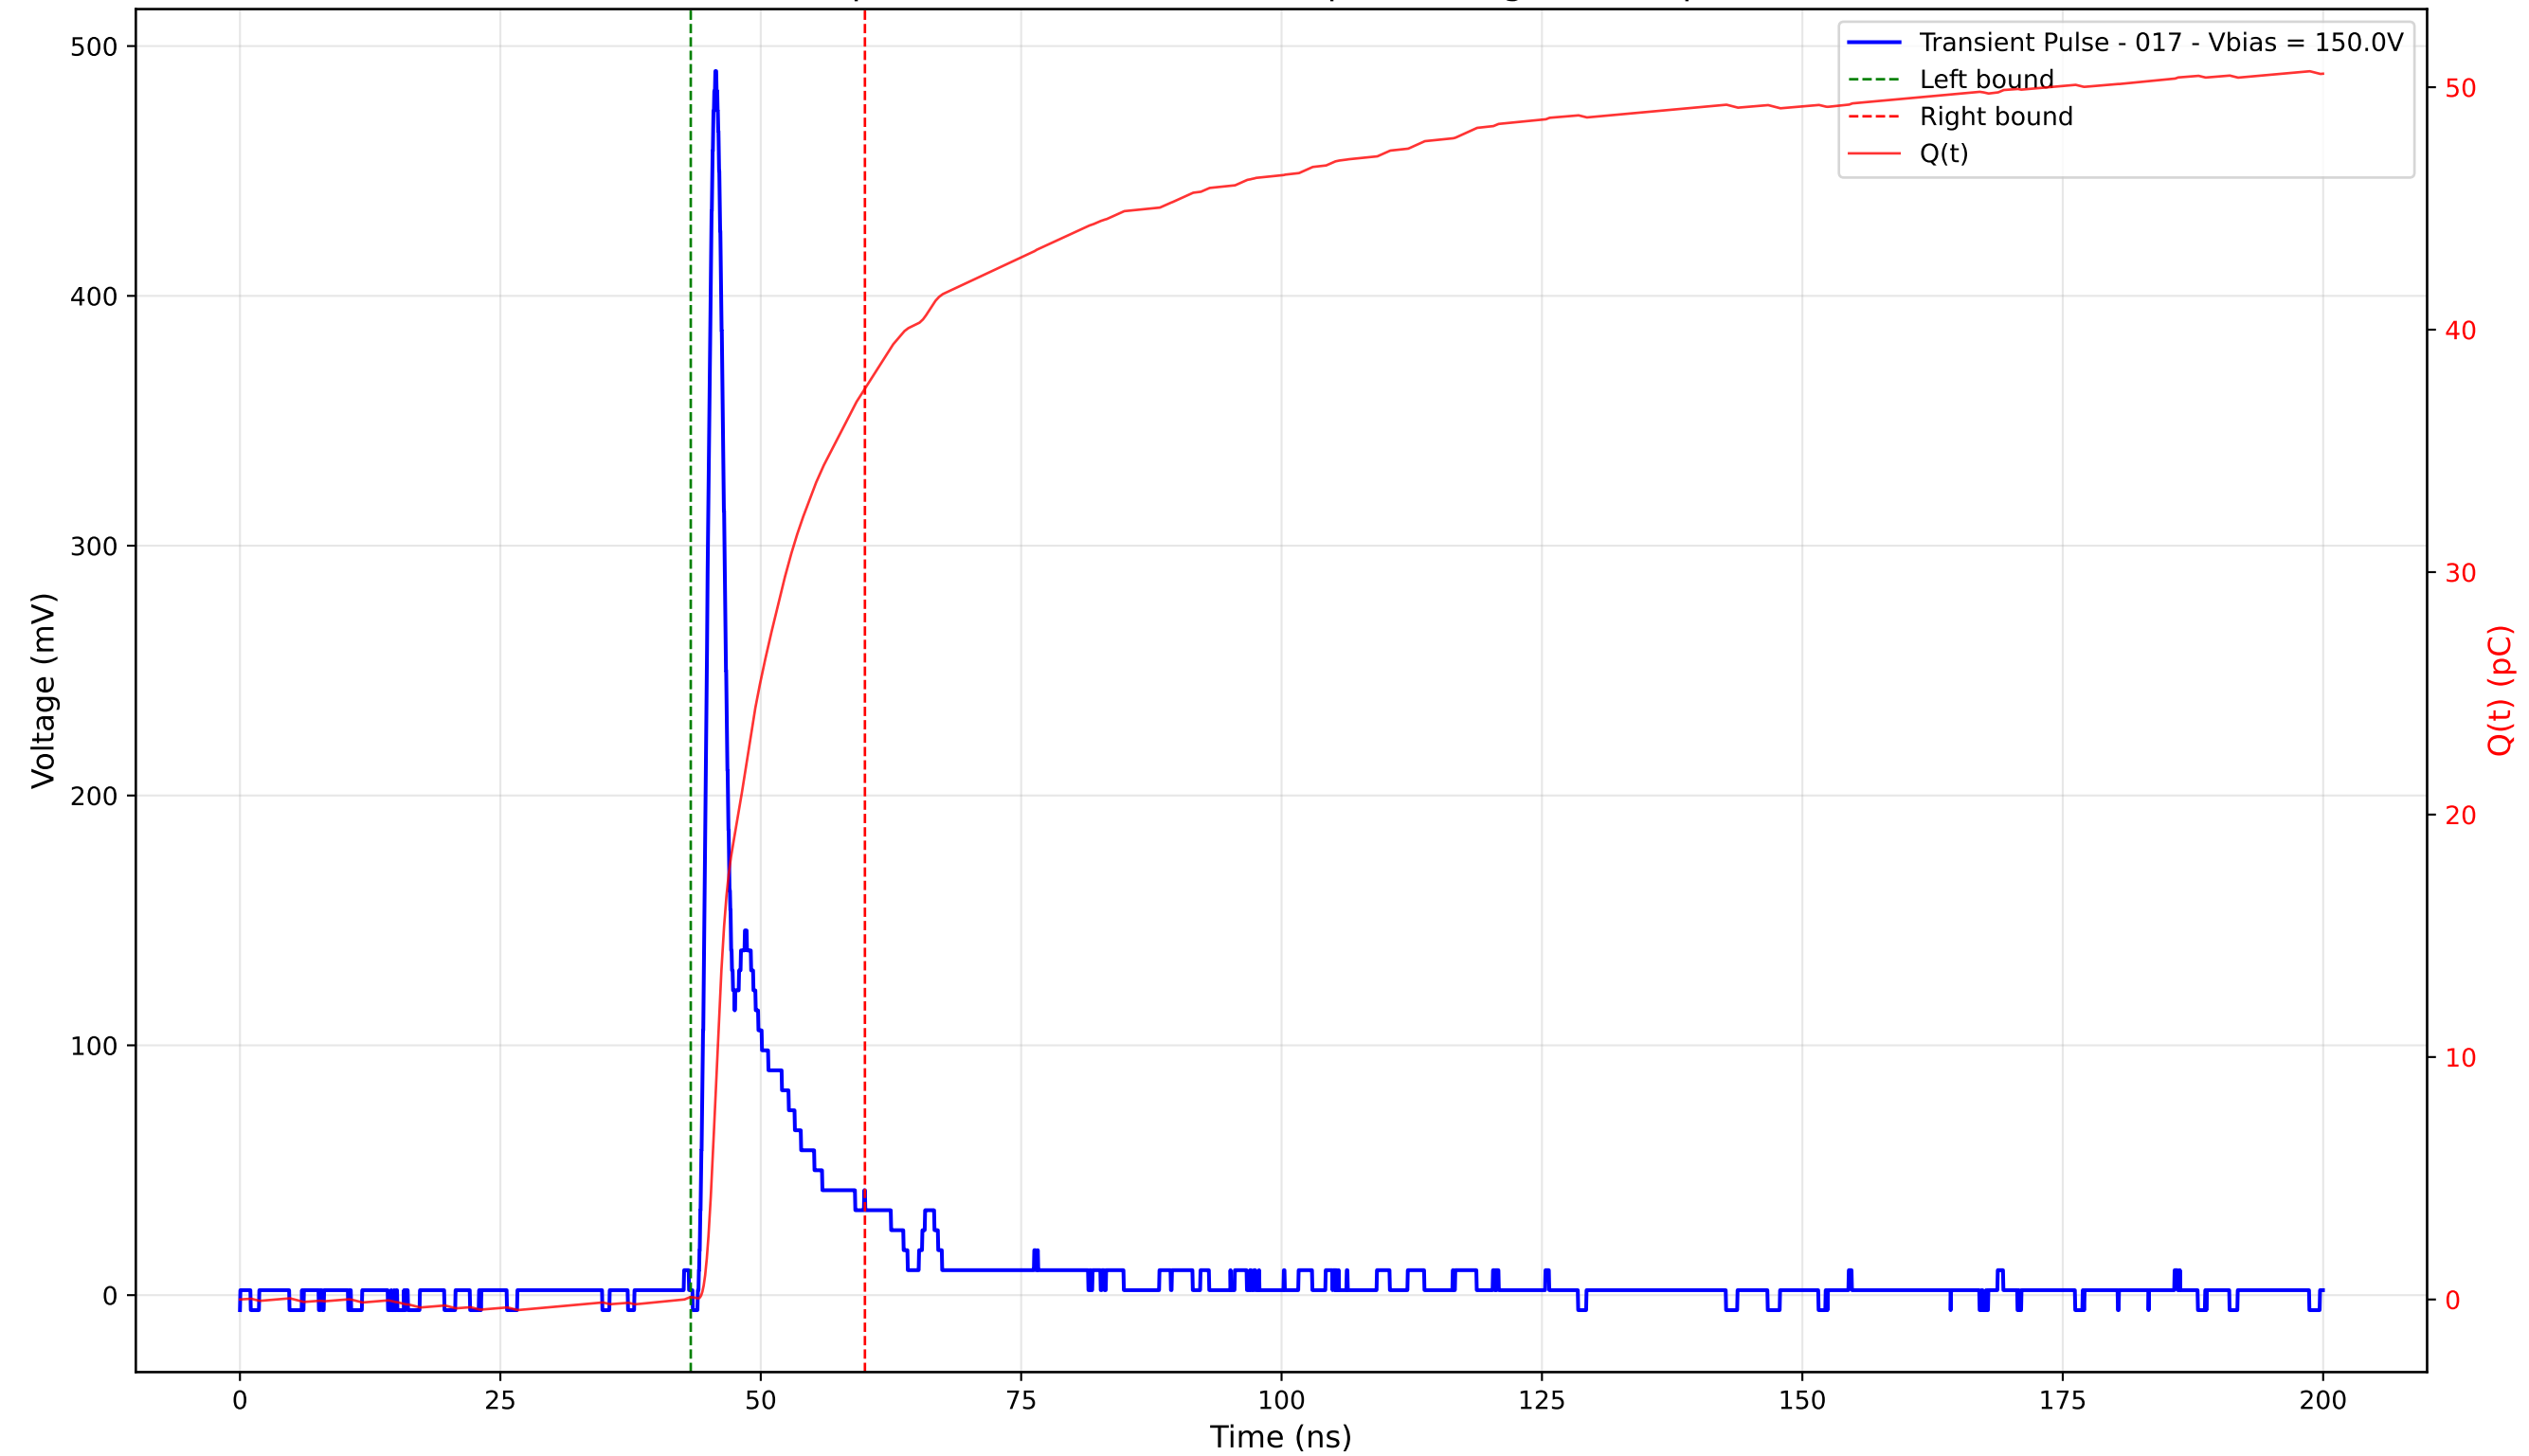


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 36.68 pC - Rise Time: 1.04 ns

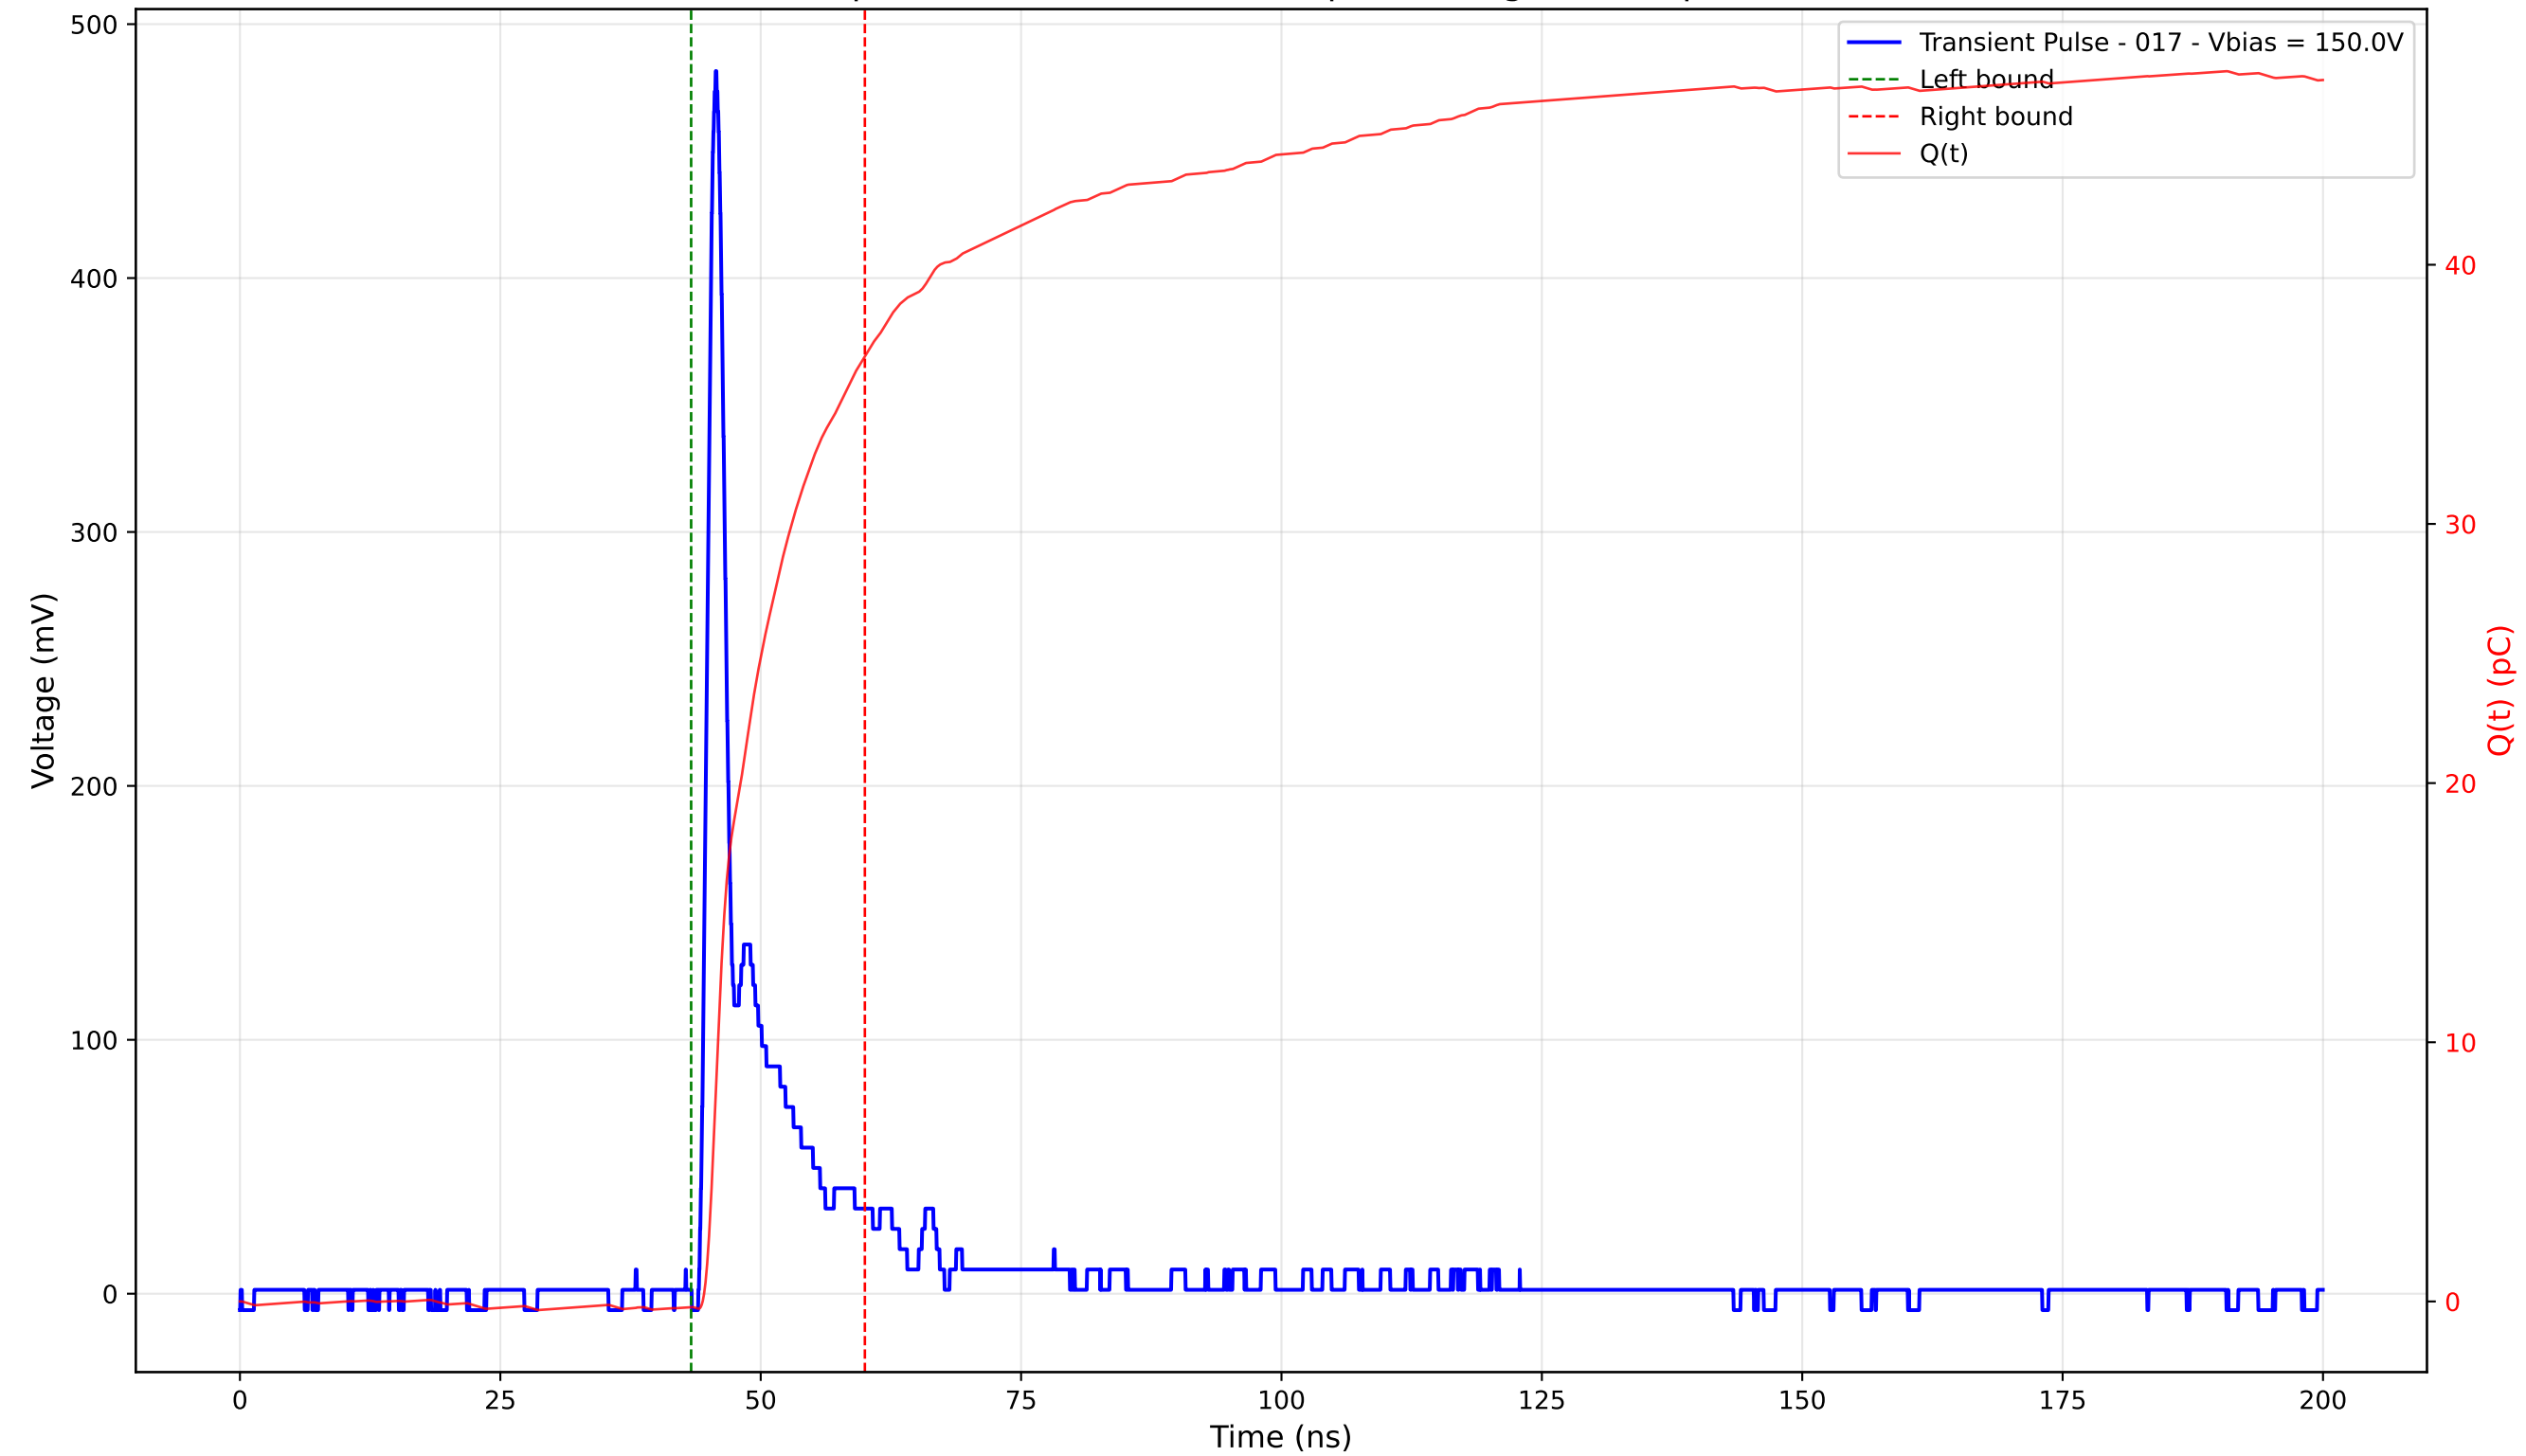


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 35.99 pC - Rise Time: 1.07 ns

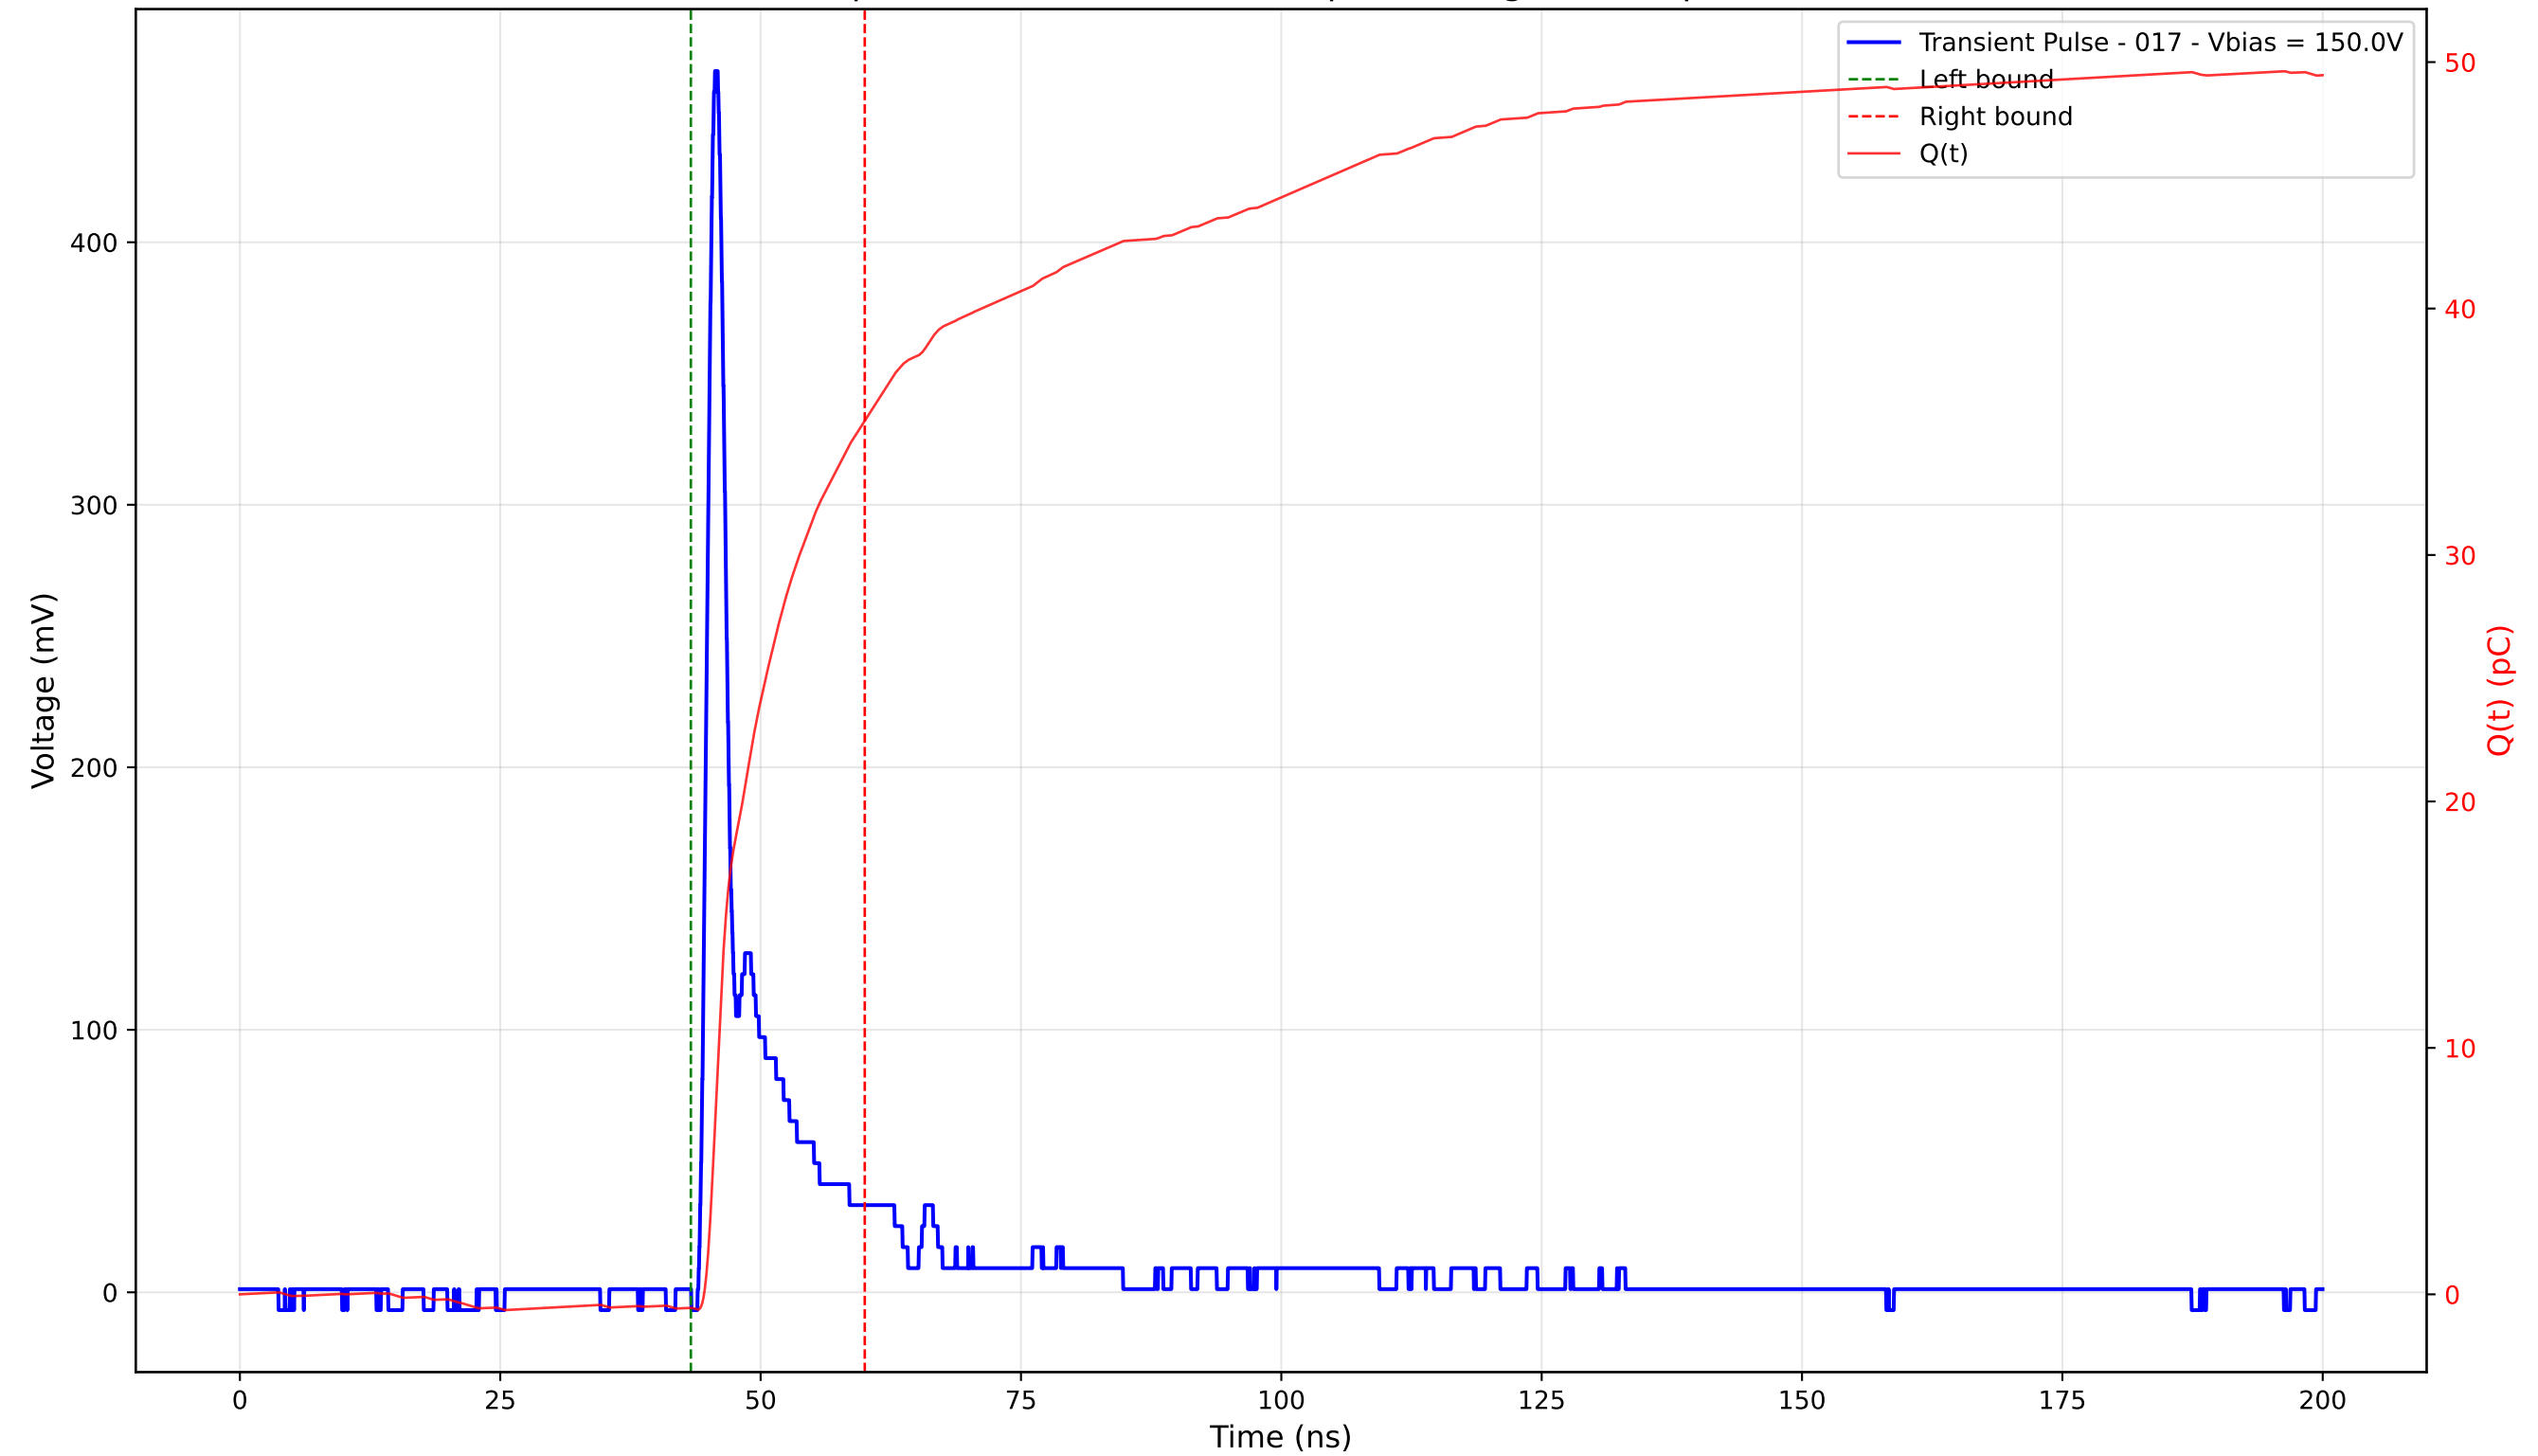


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 35.86 pC - Rise Time: 1.08 ns

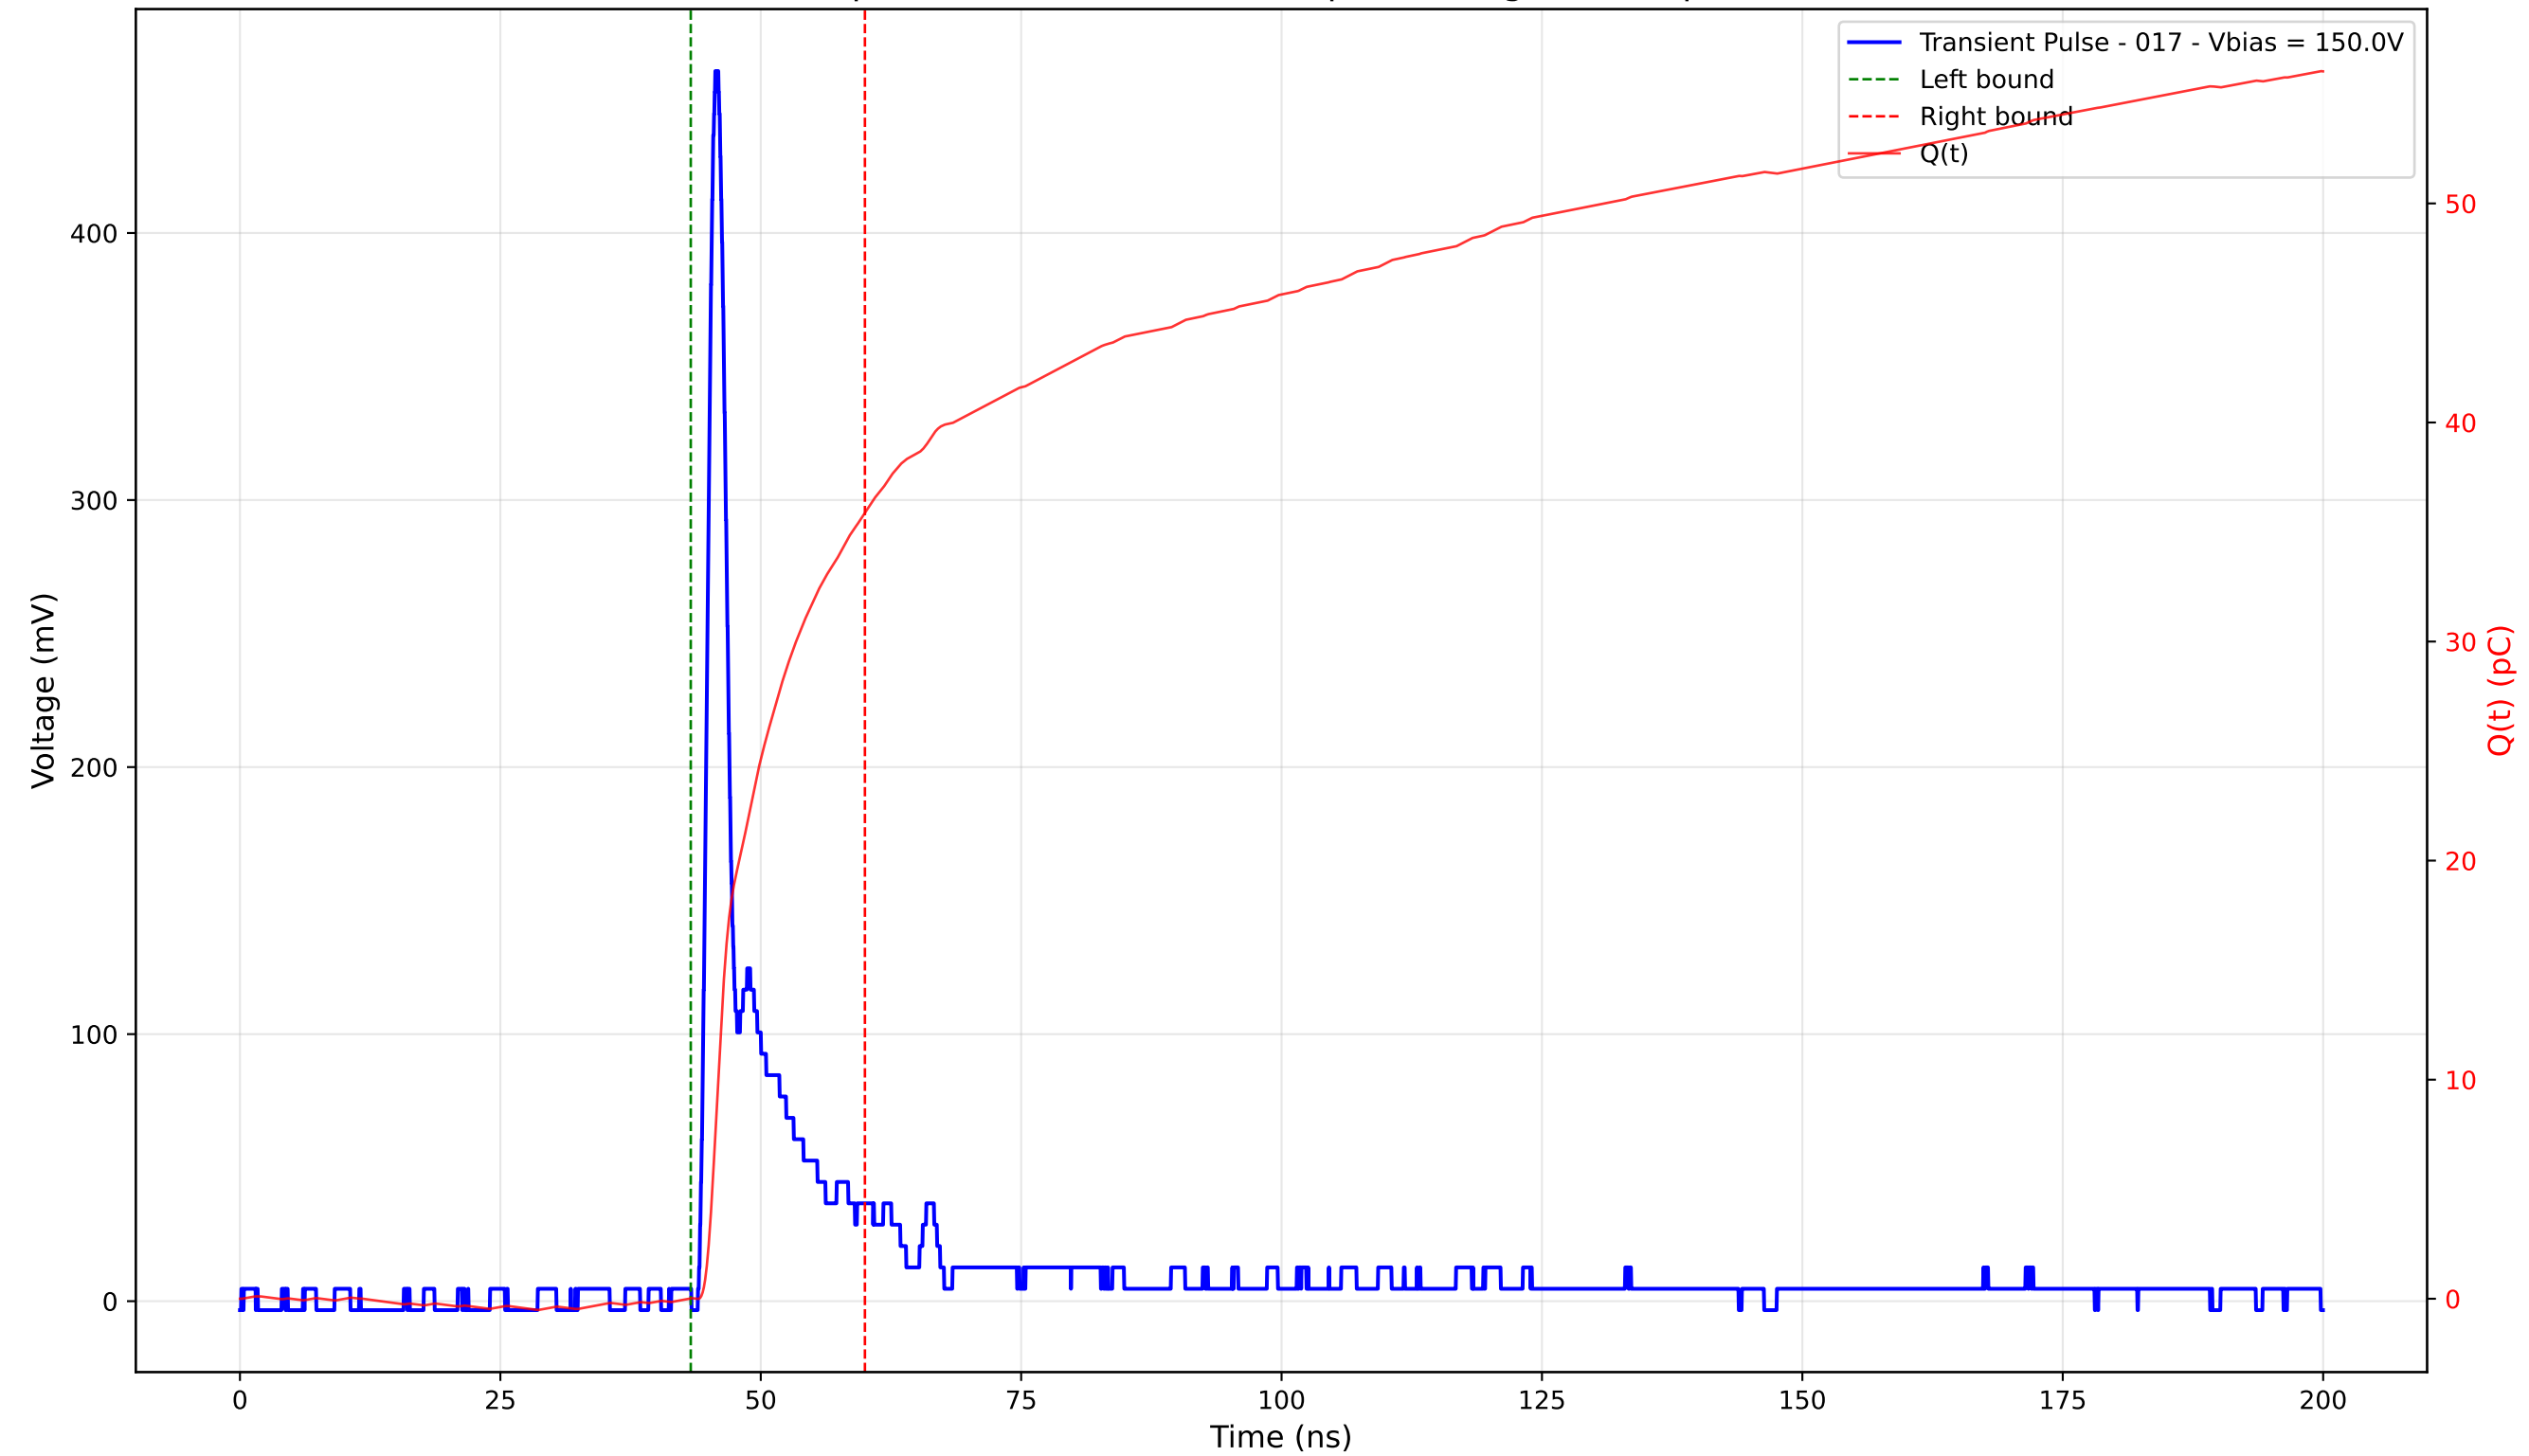


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 35.20 pC - Rise Time: 1.14 ns

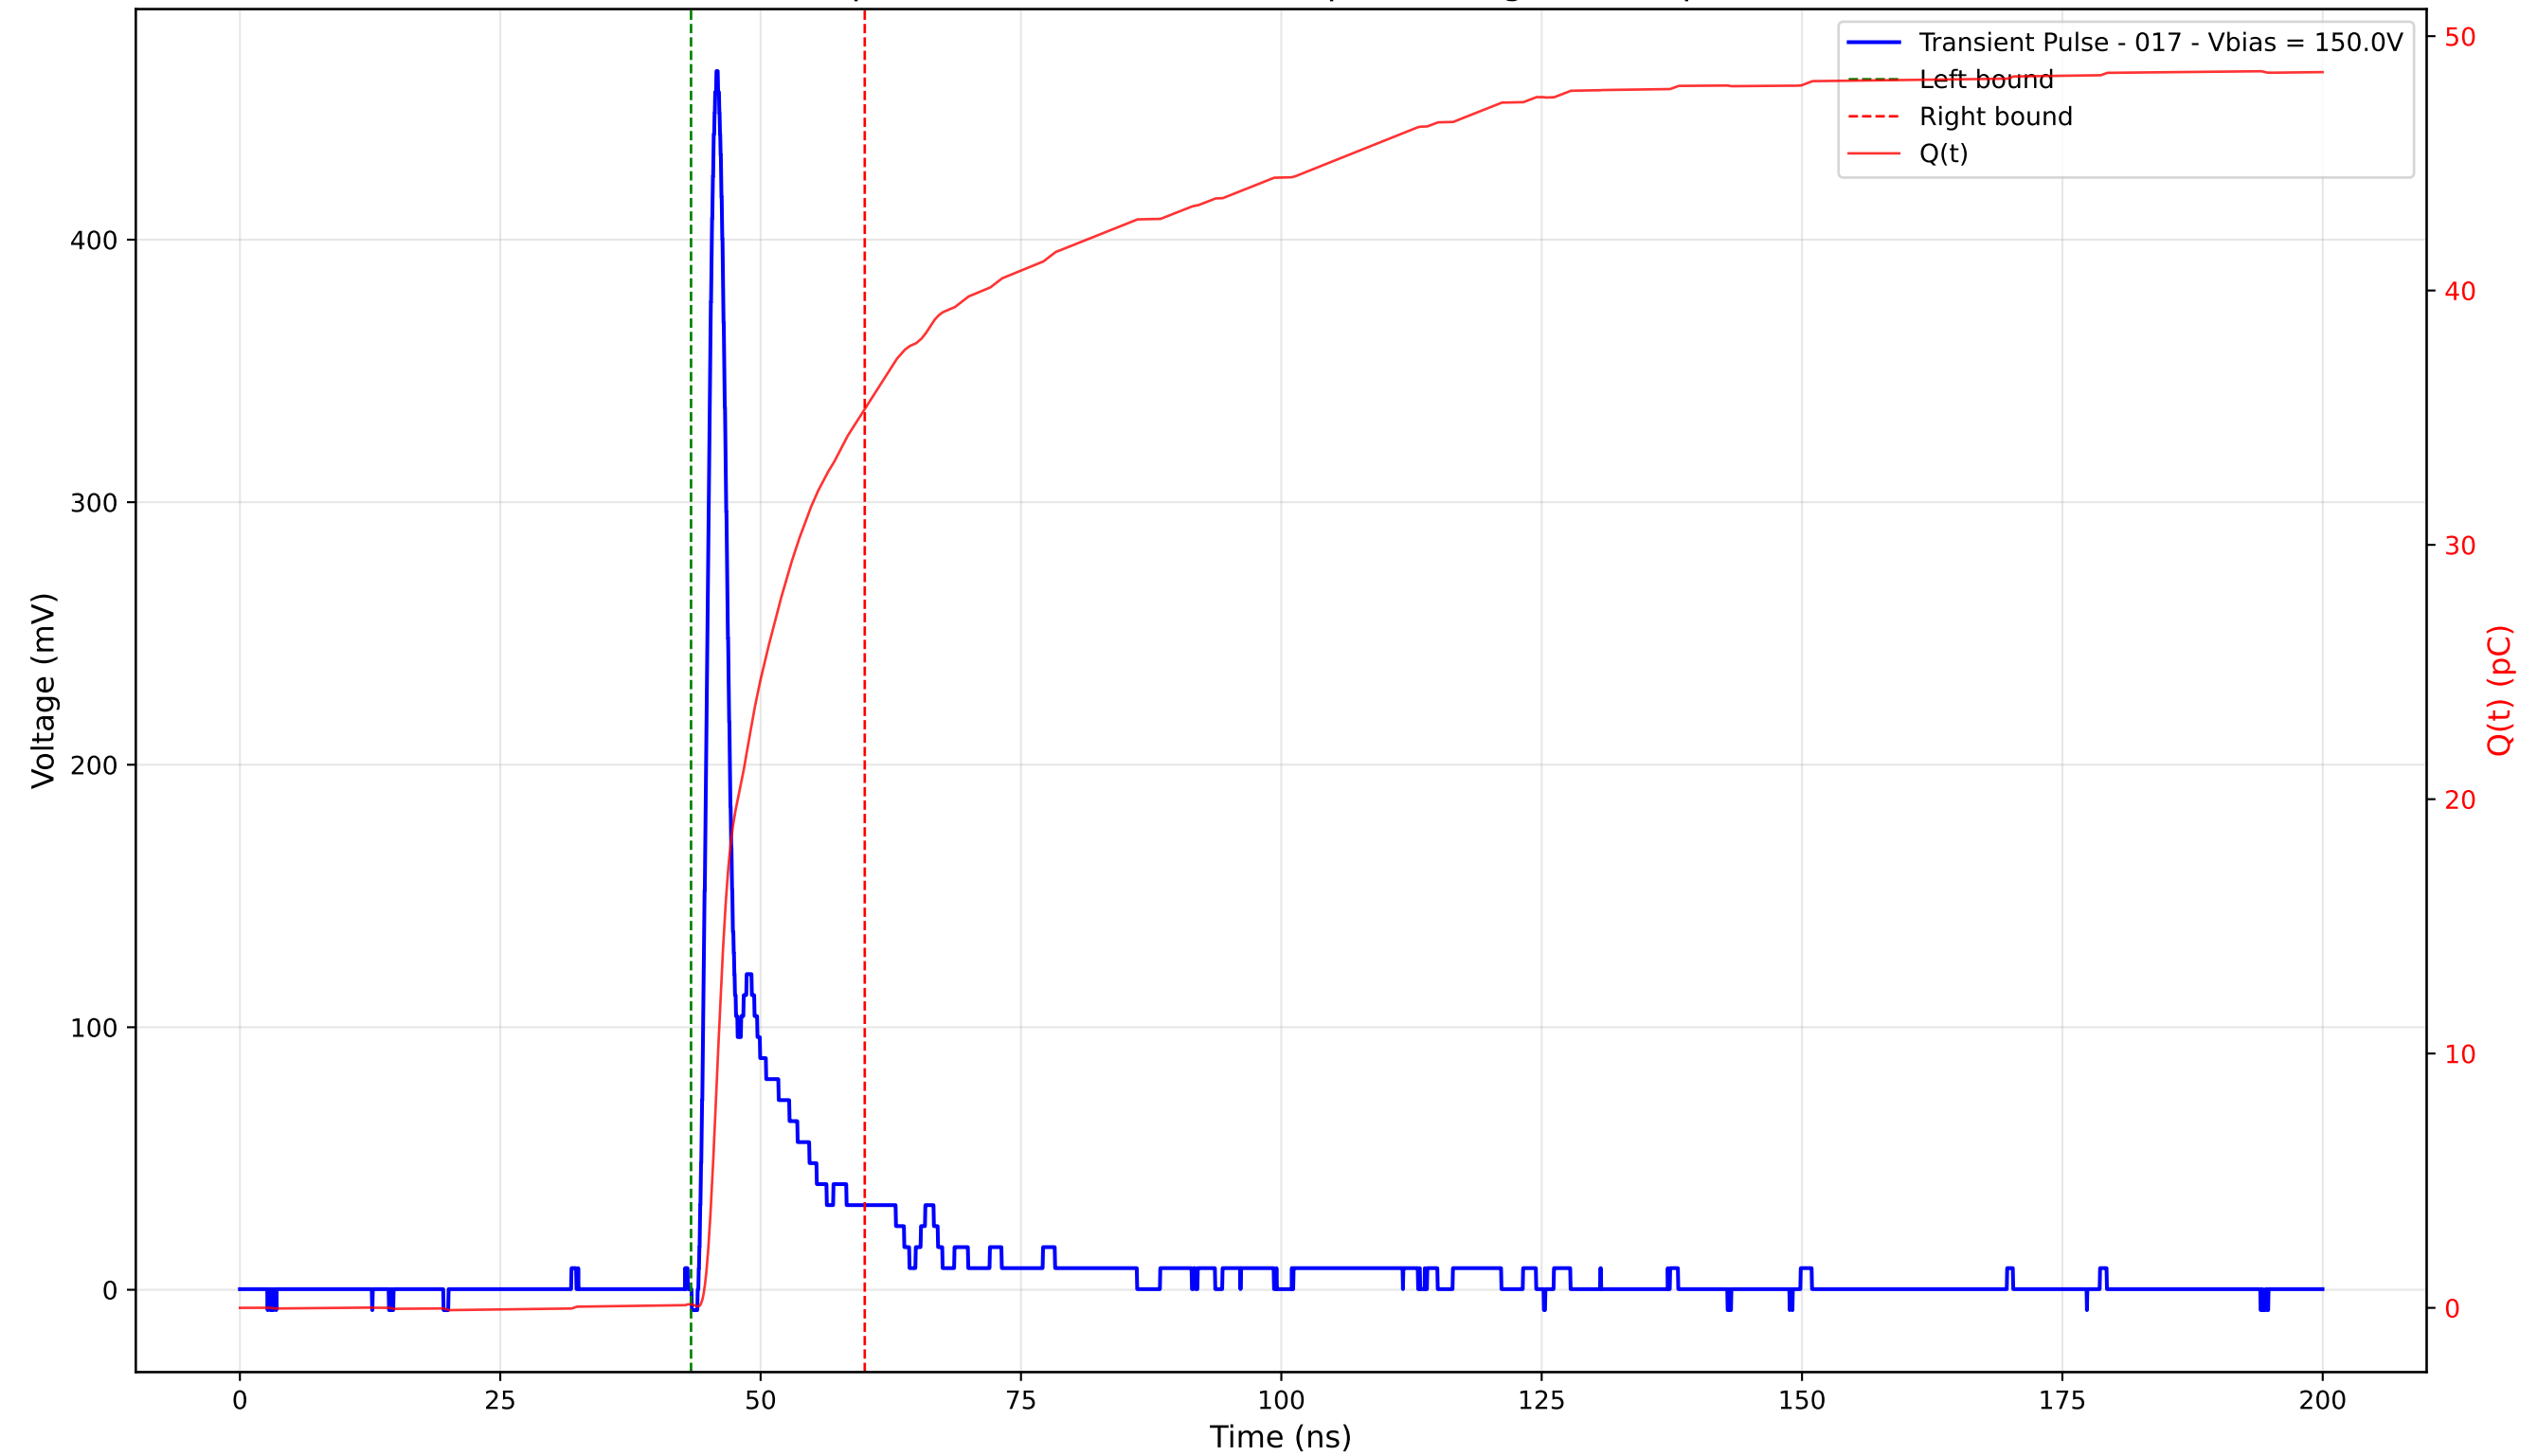


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 35.29 pC - Rise Time: 1.15 ns

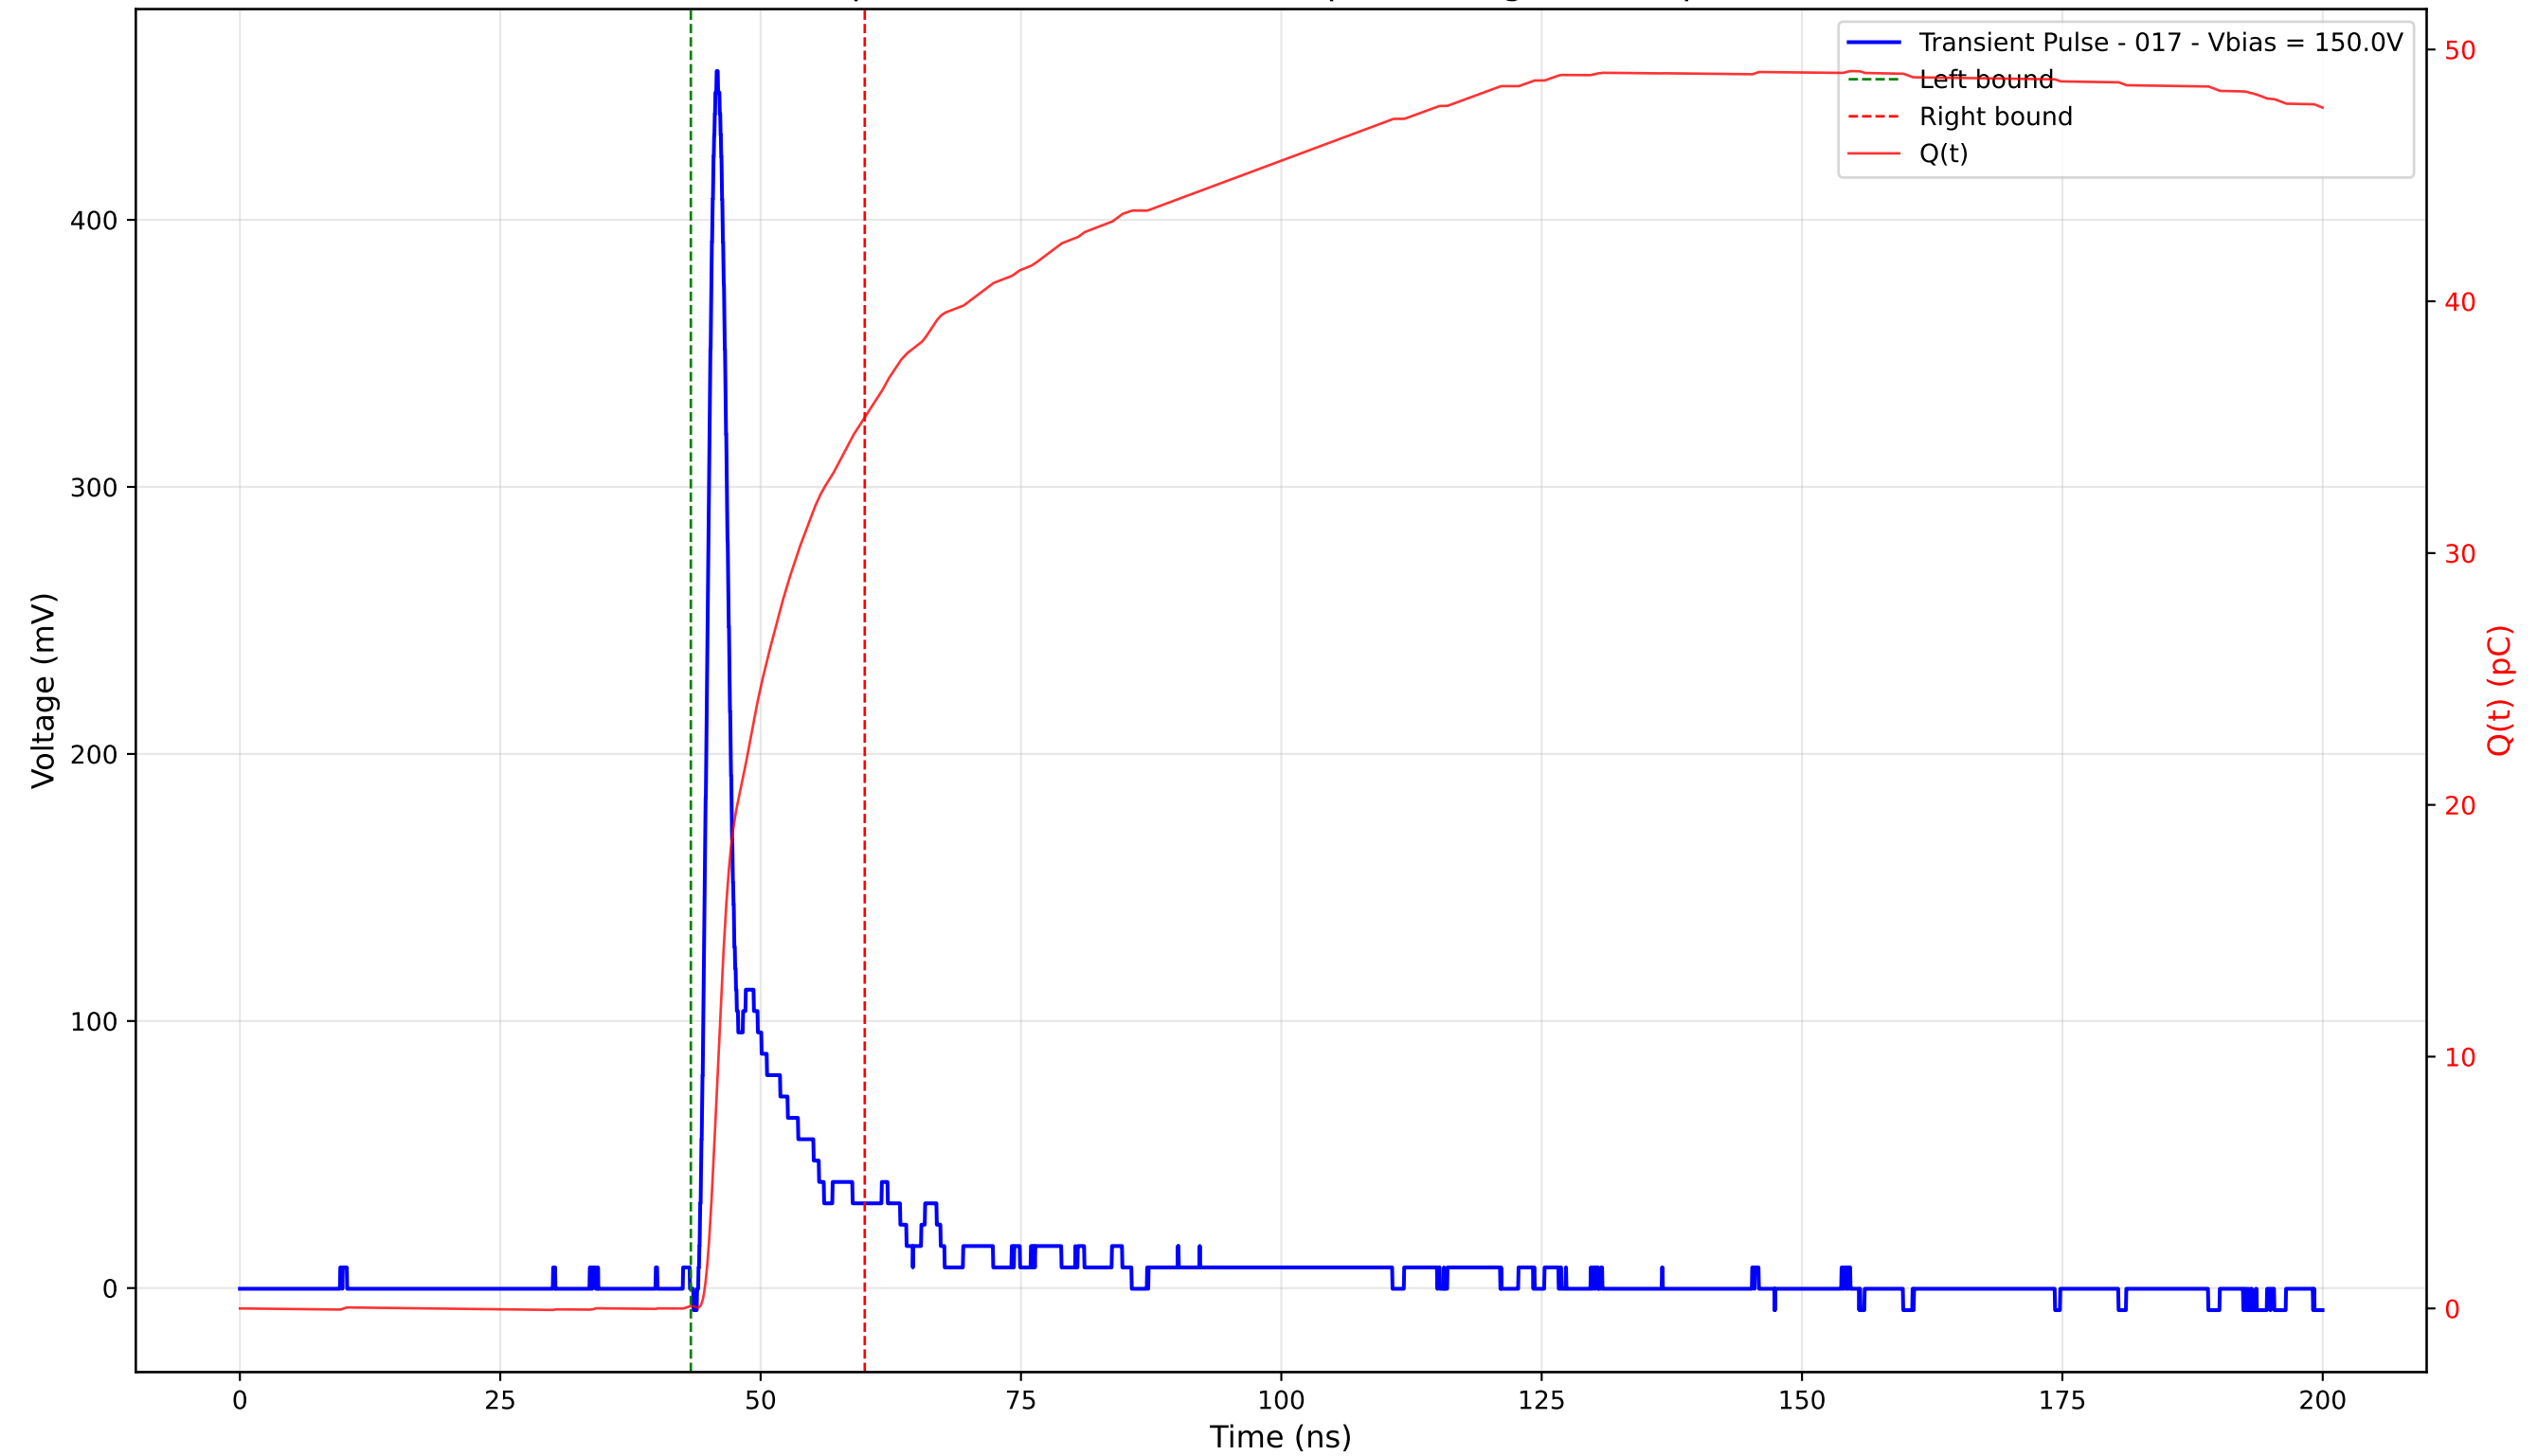


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 35.02 pC - Rise Time: 1.16 ns

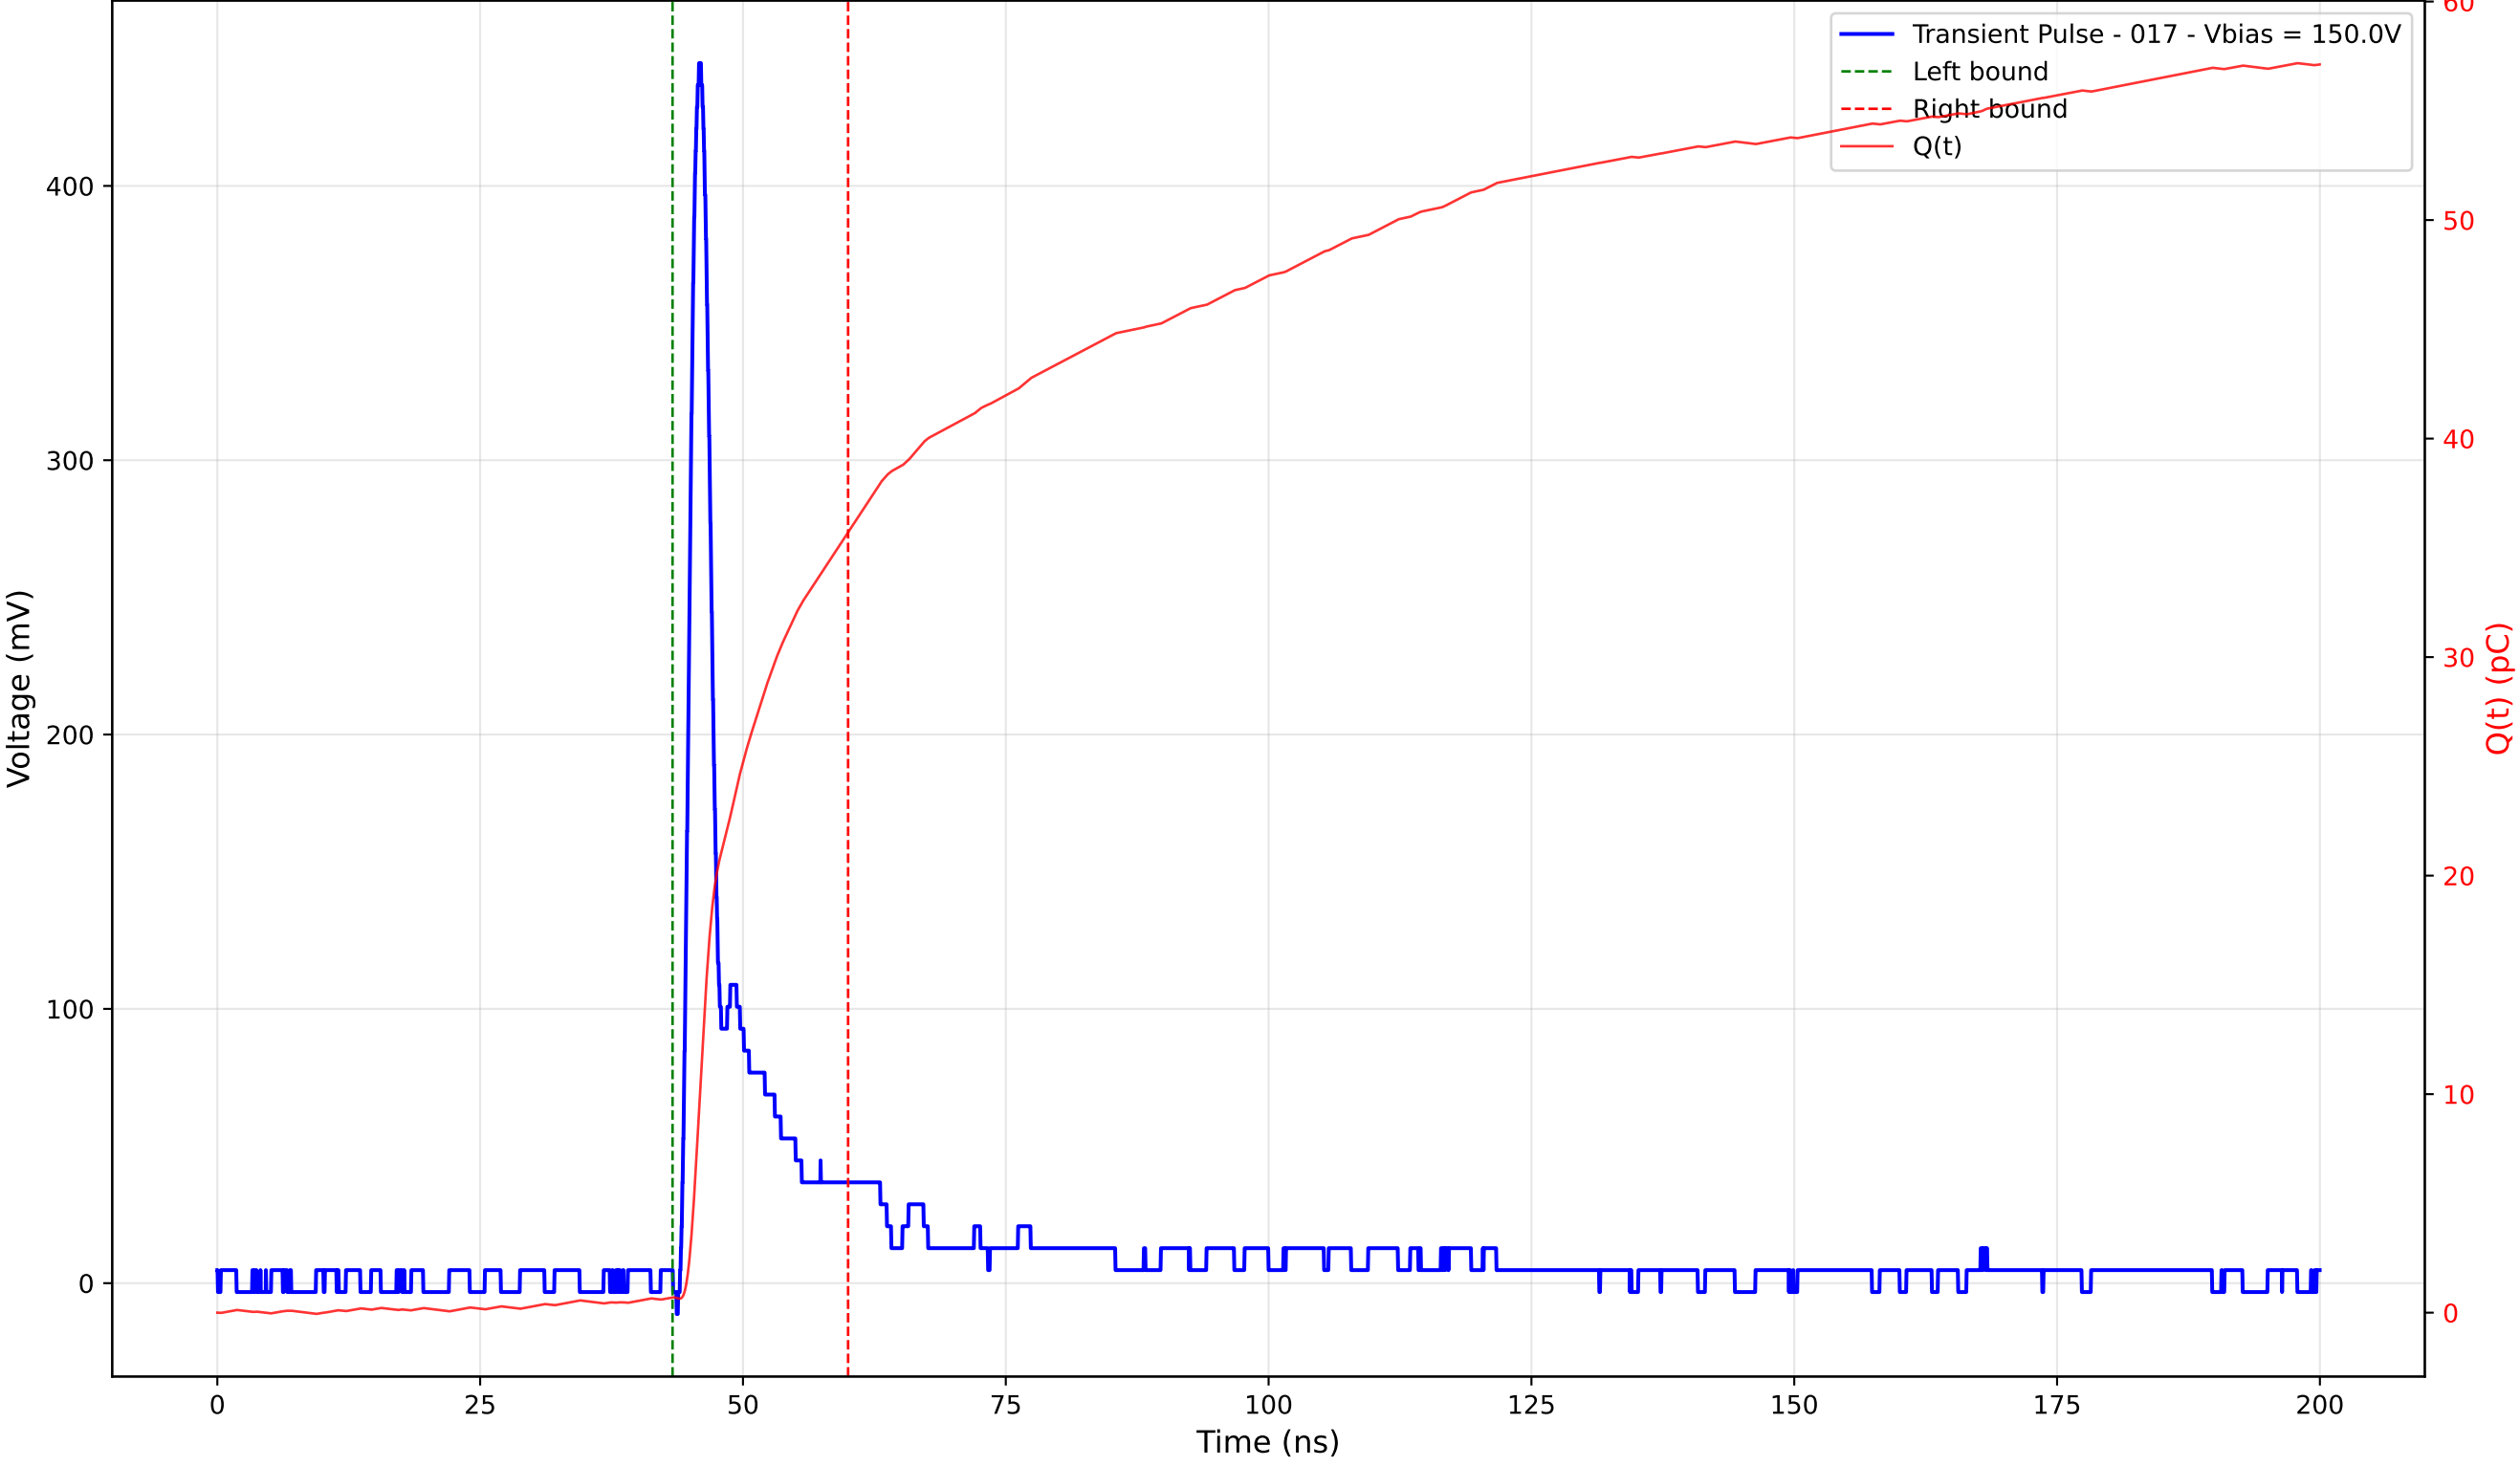


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 33.46 pC - Rise Time: 1.14 ns

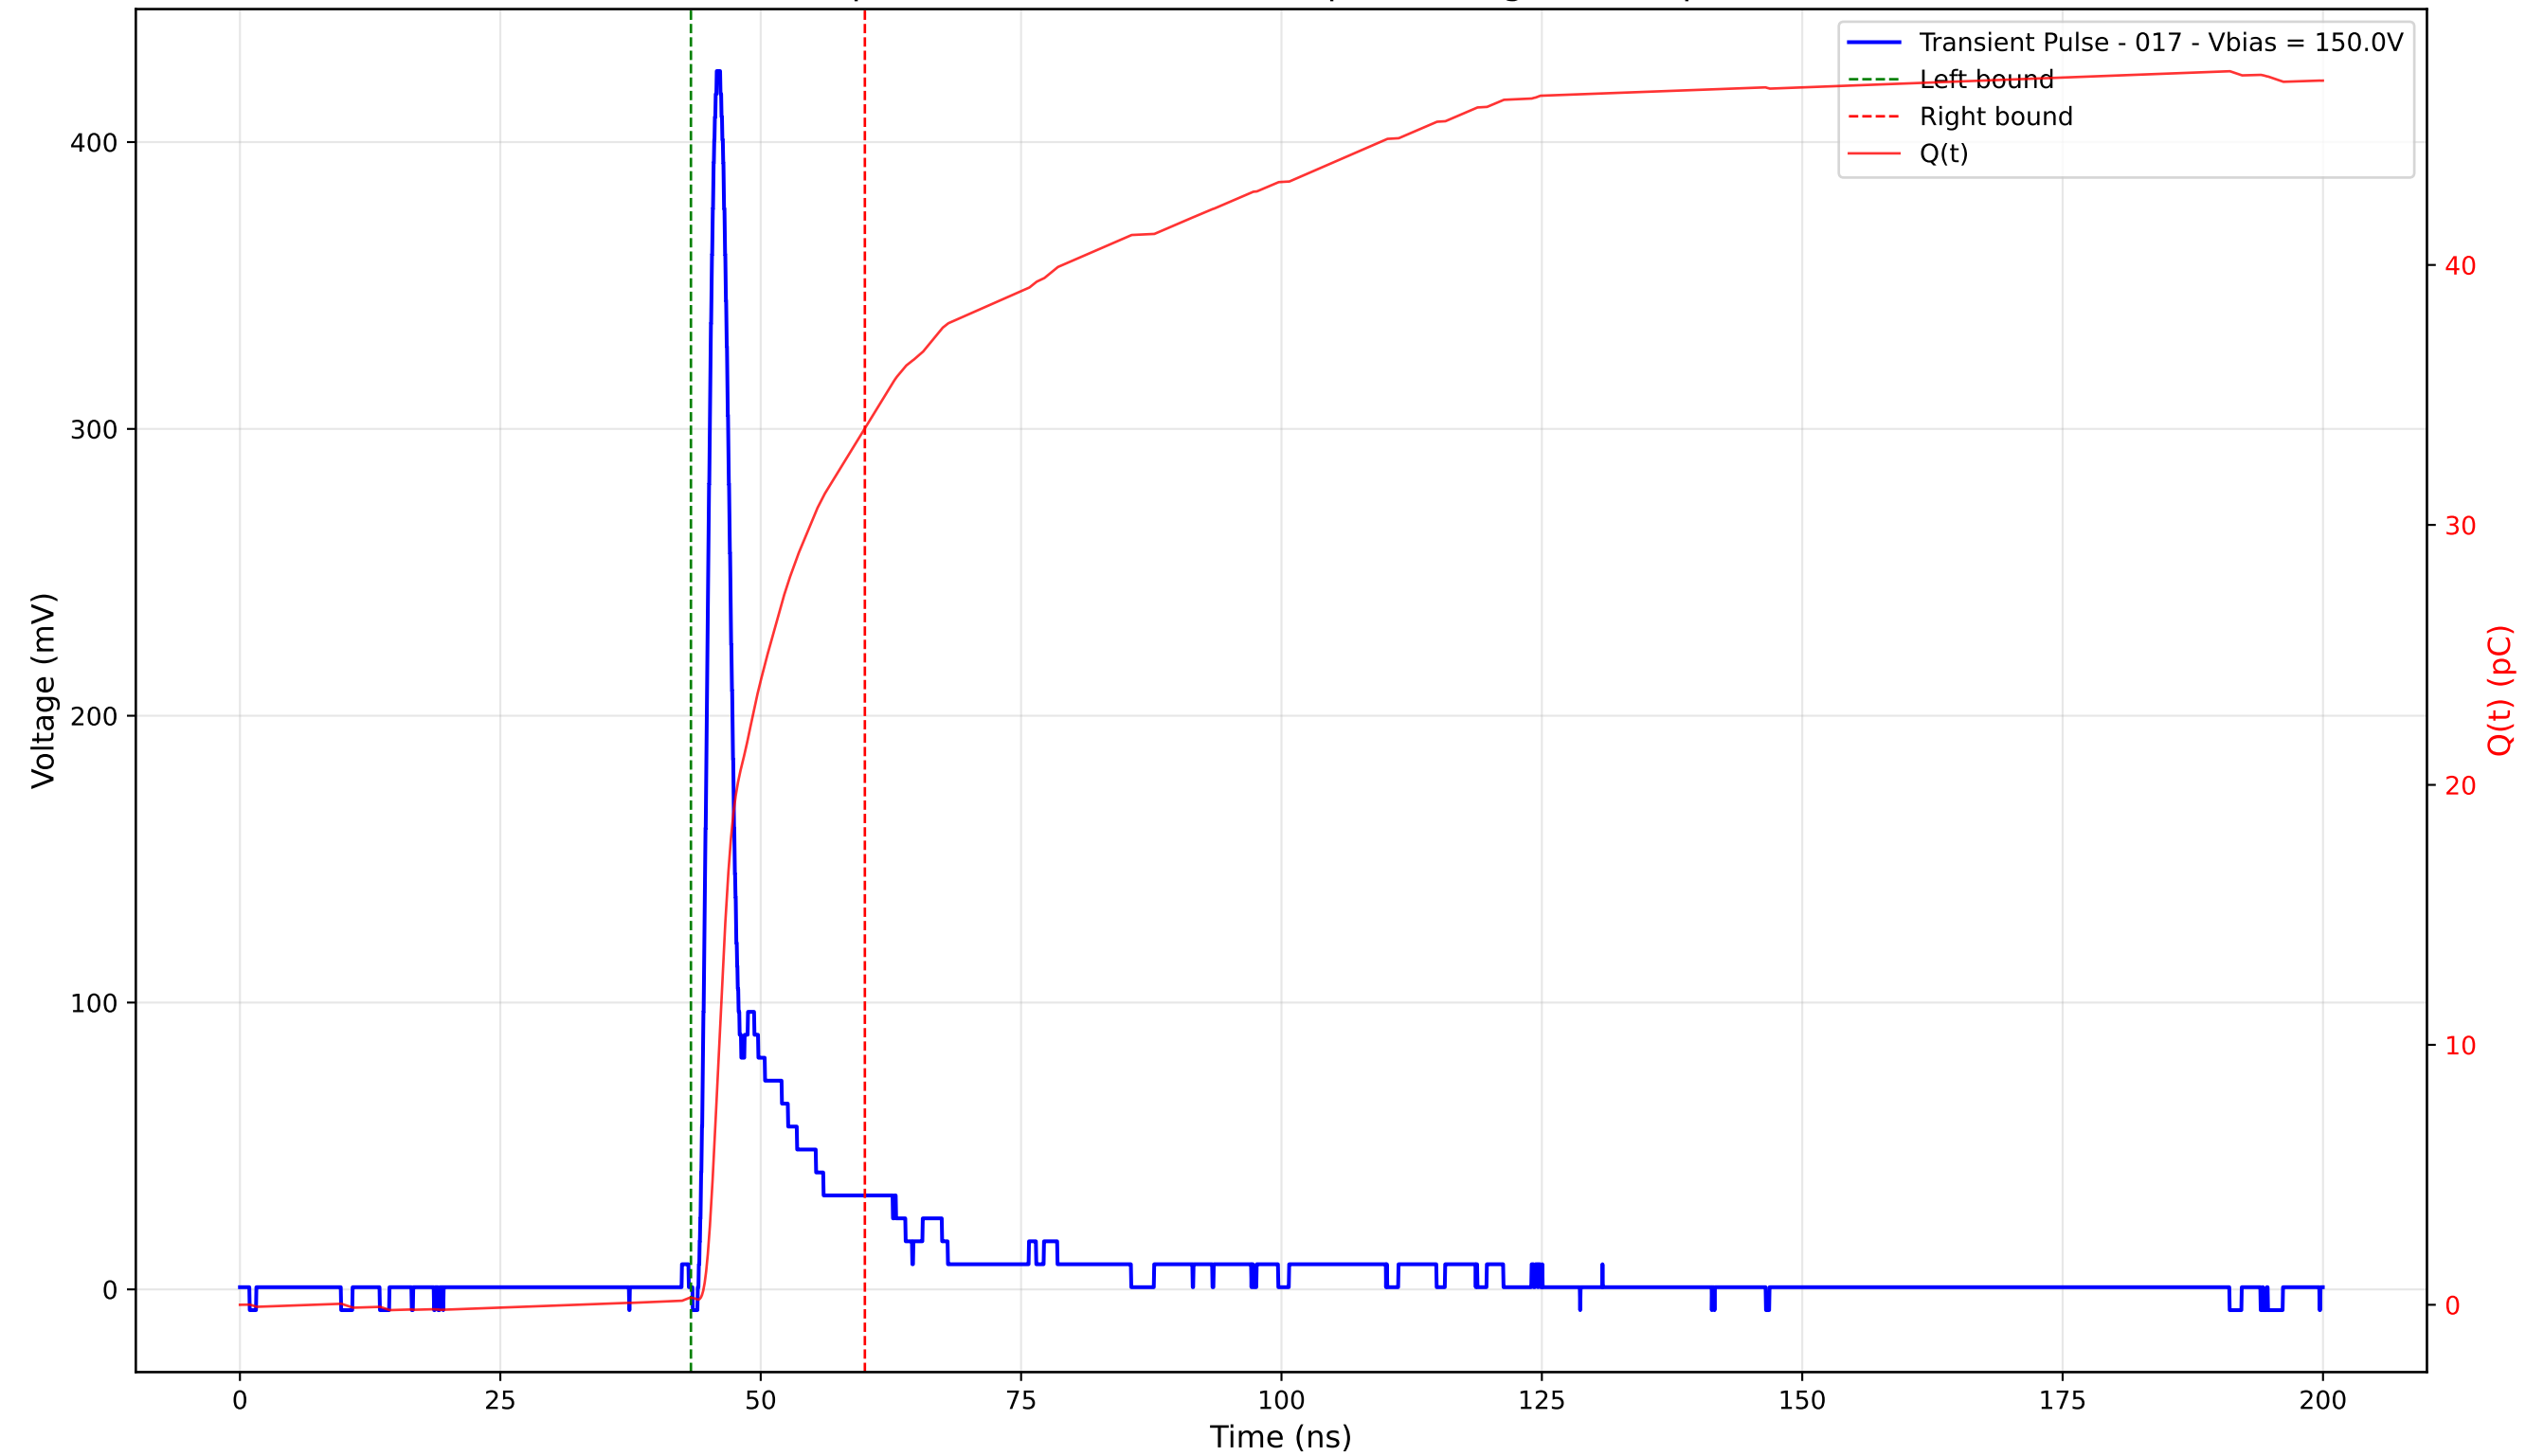


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 33.32 pC - Rise Time: 1.15 ns

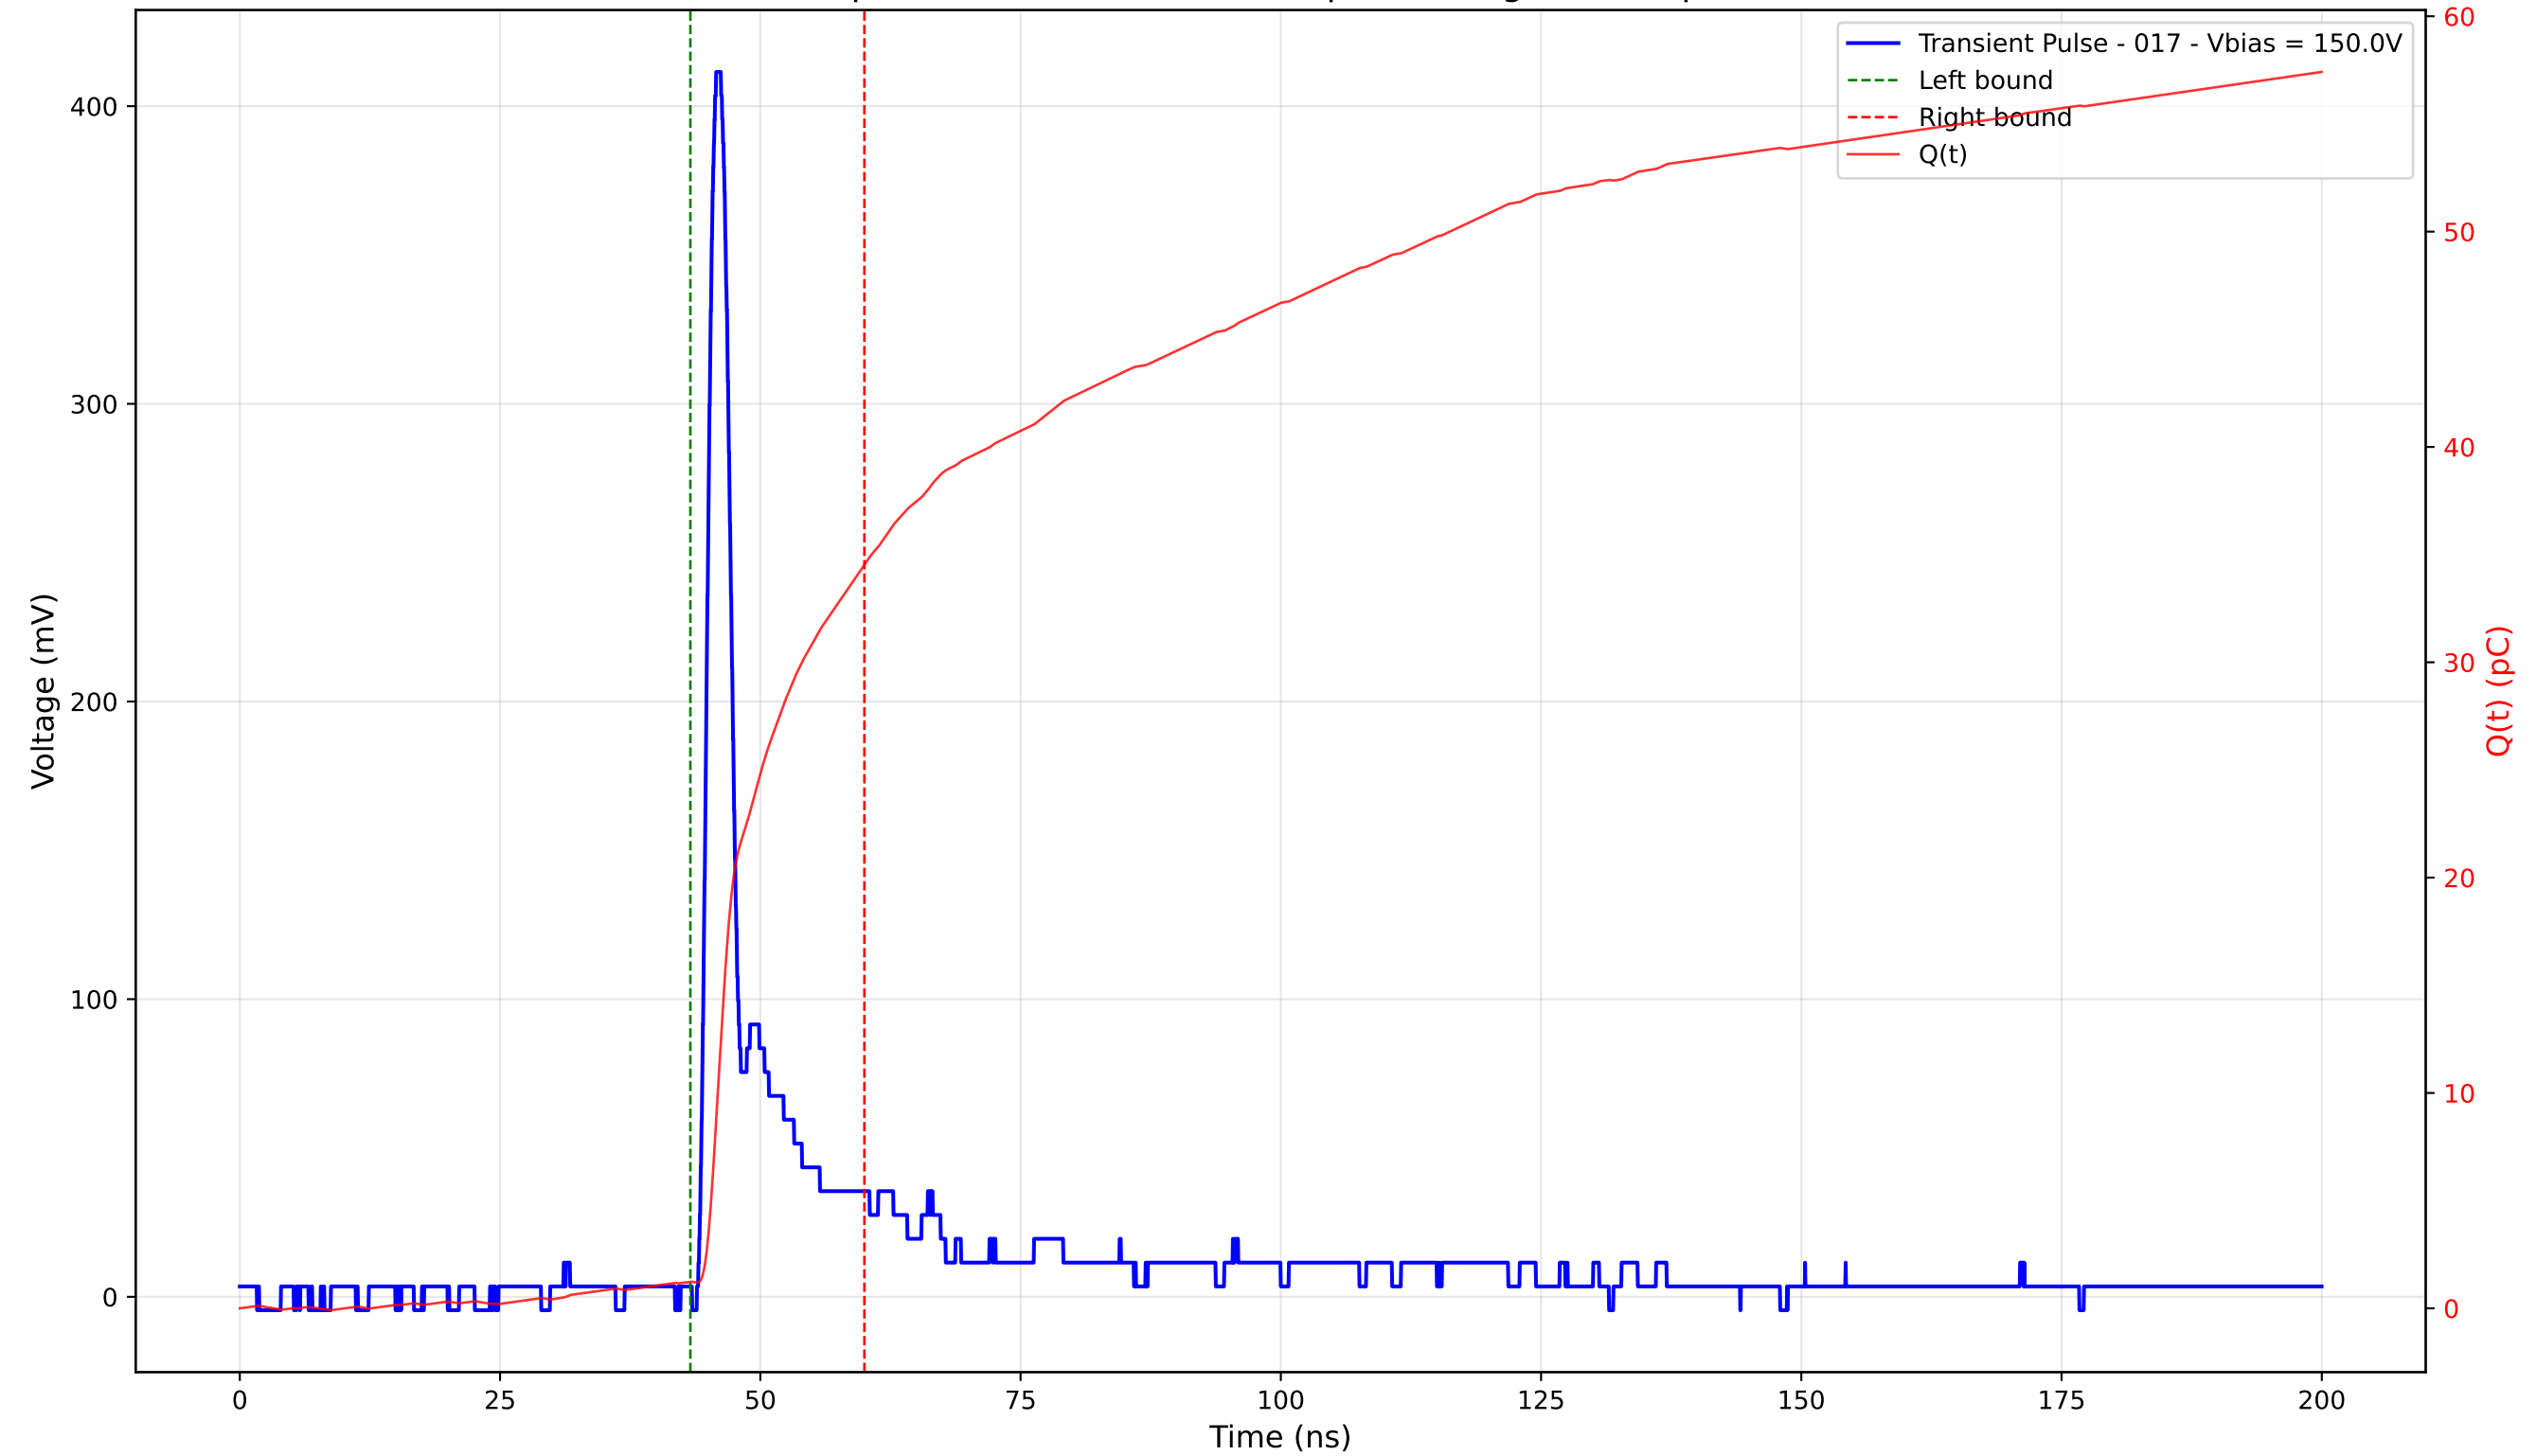


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 31.90 pC - Rise Time: 1.18 ns

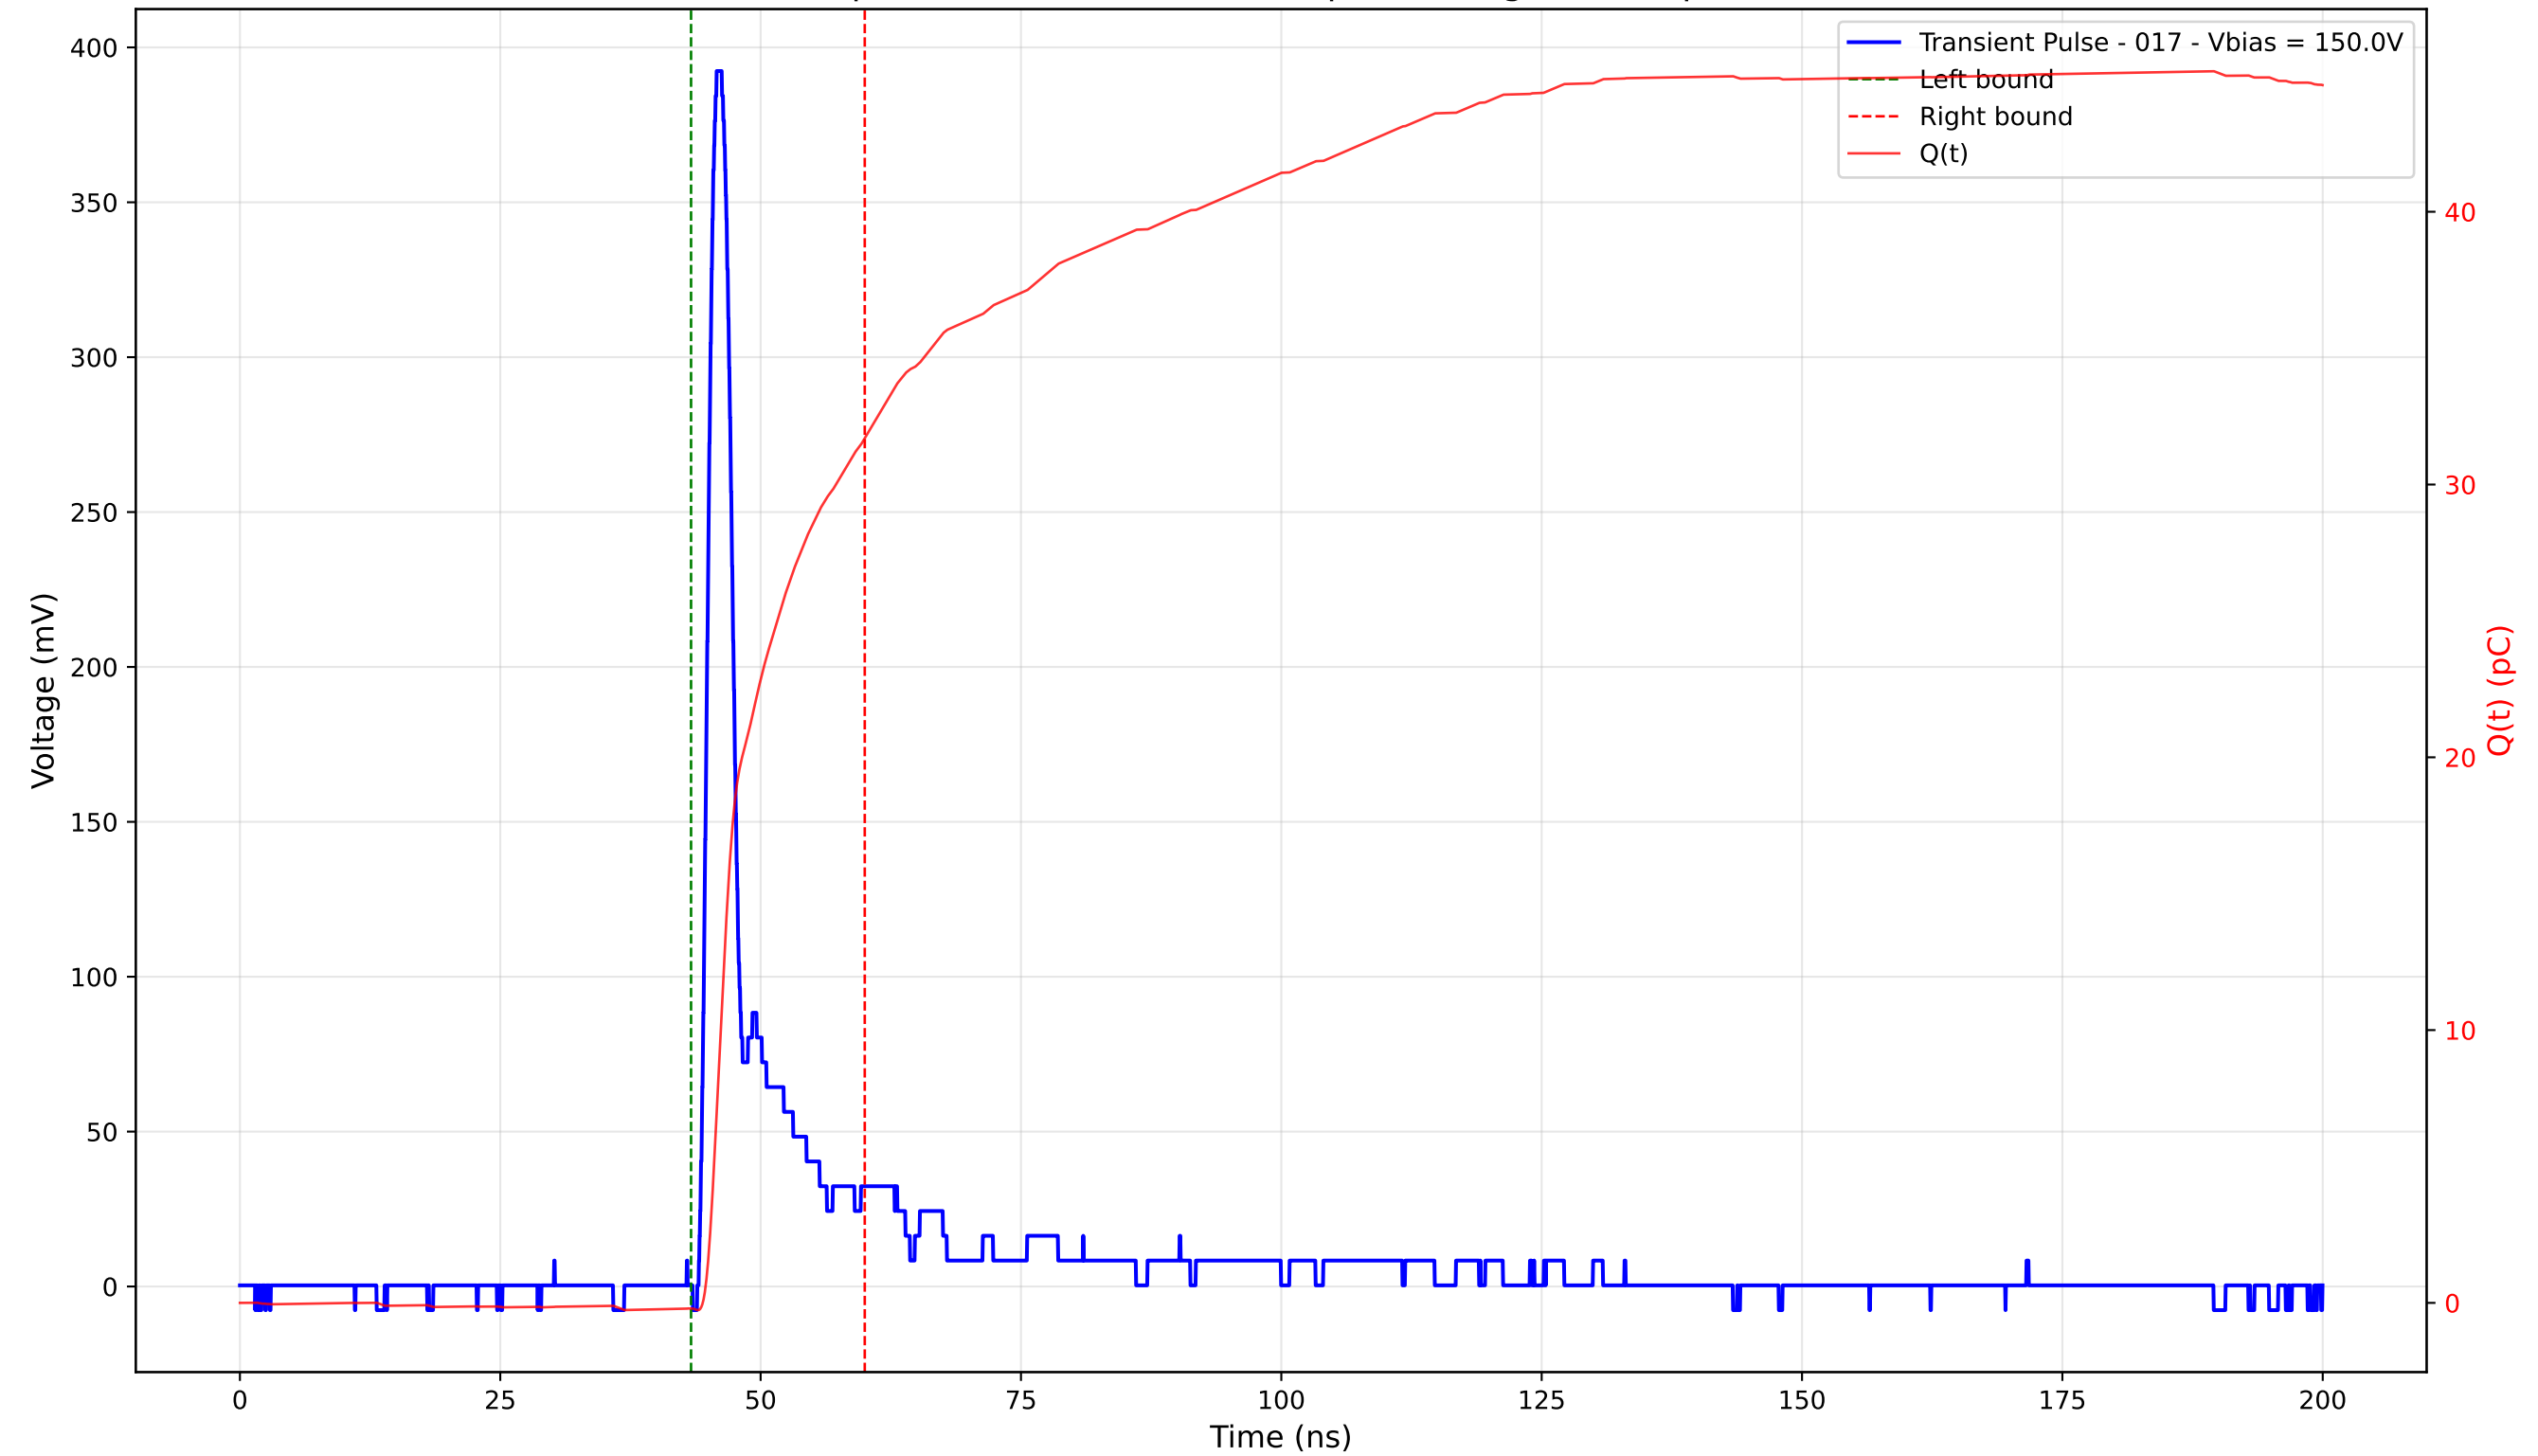


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 30.46 pC - Rise Time: 1.17 ns

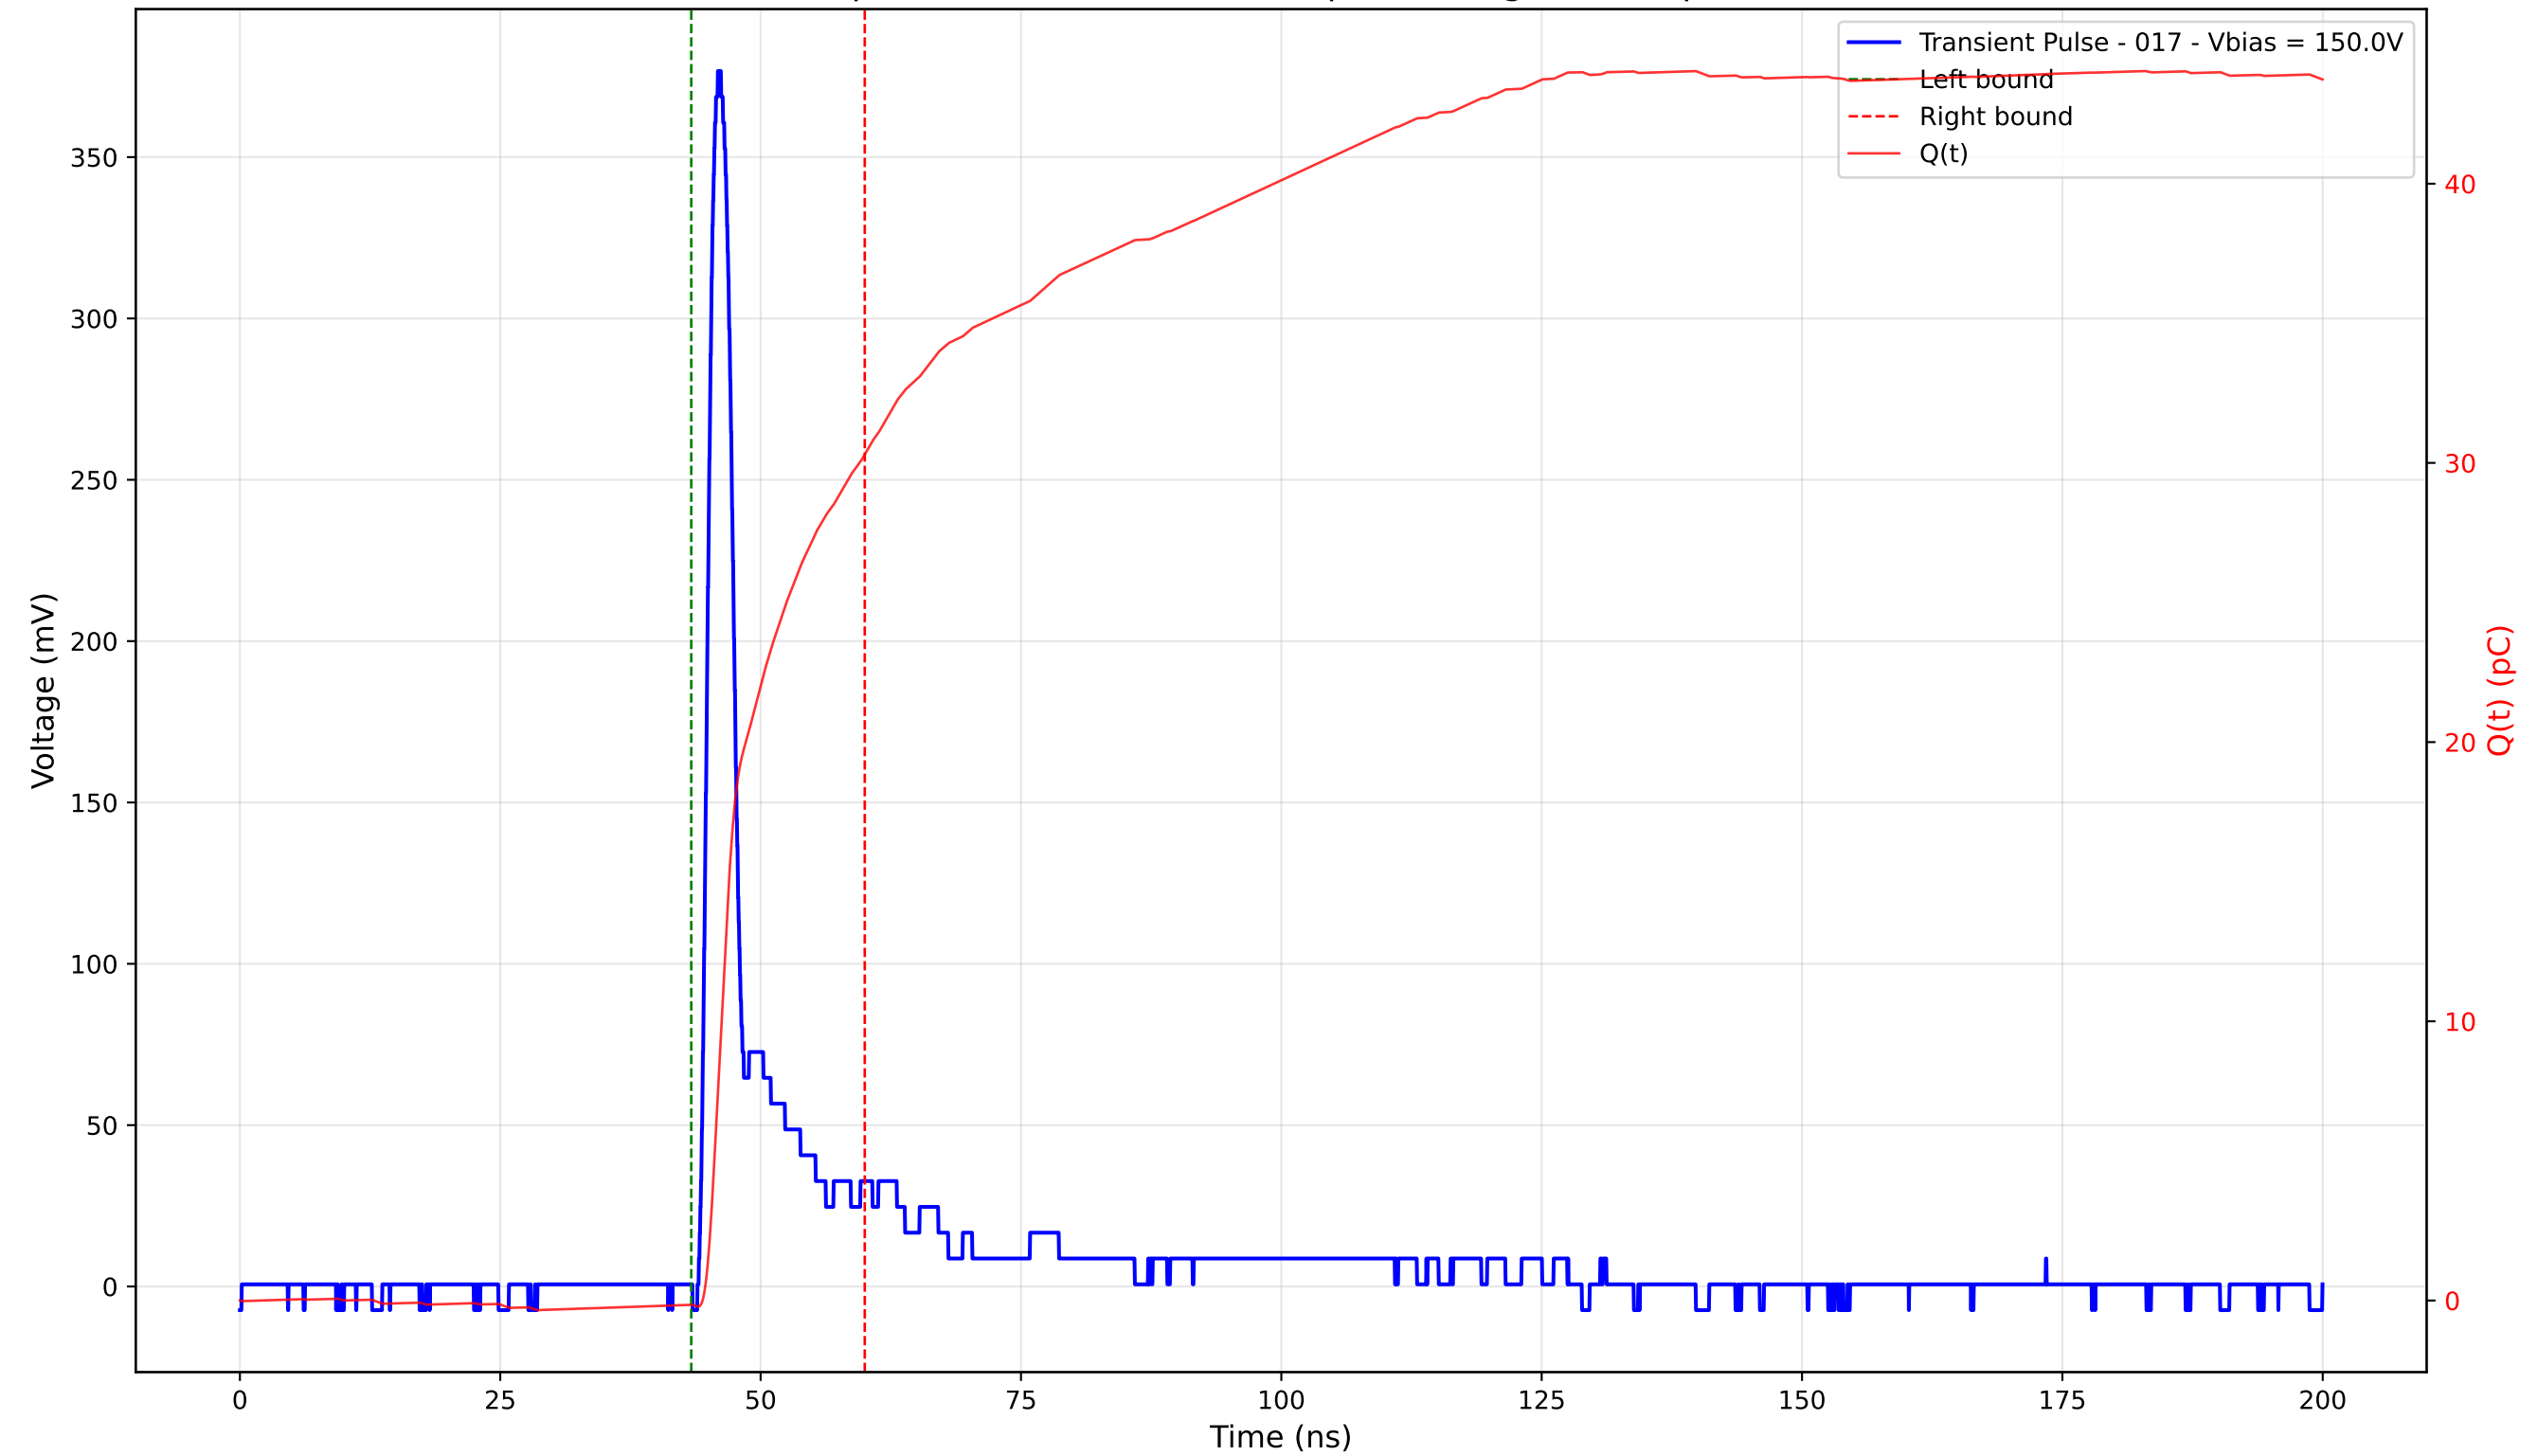


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 30.11 pC - Rise Time: 1.19 ns

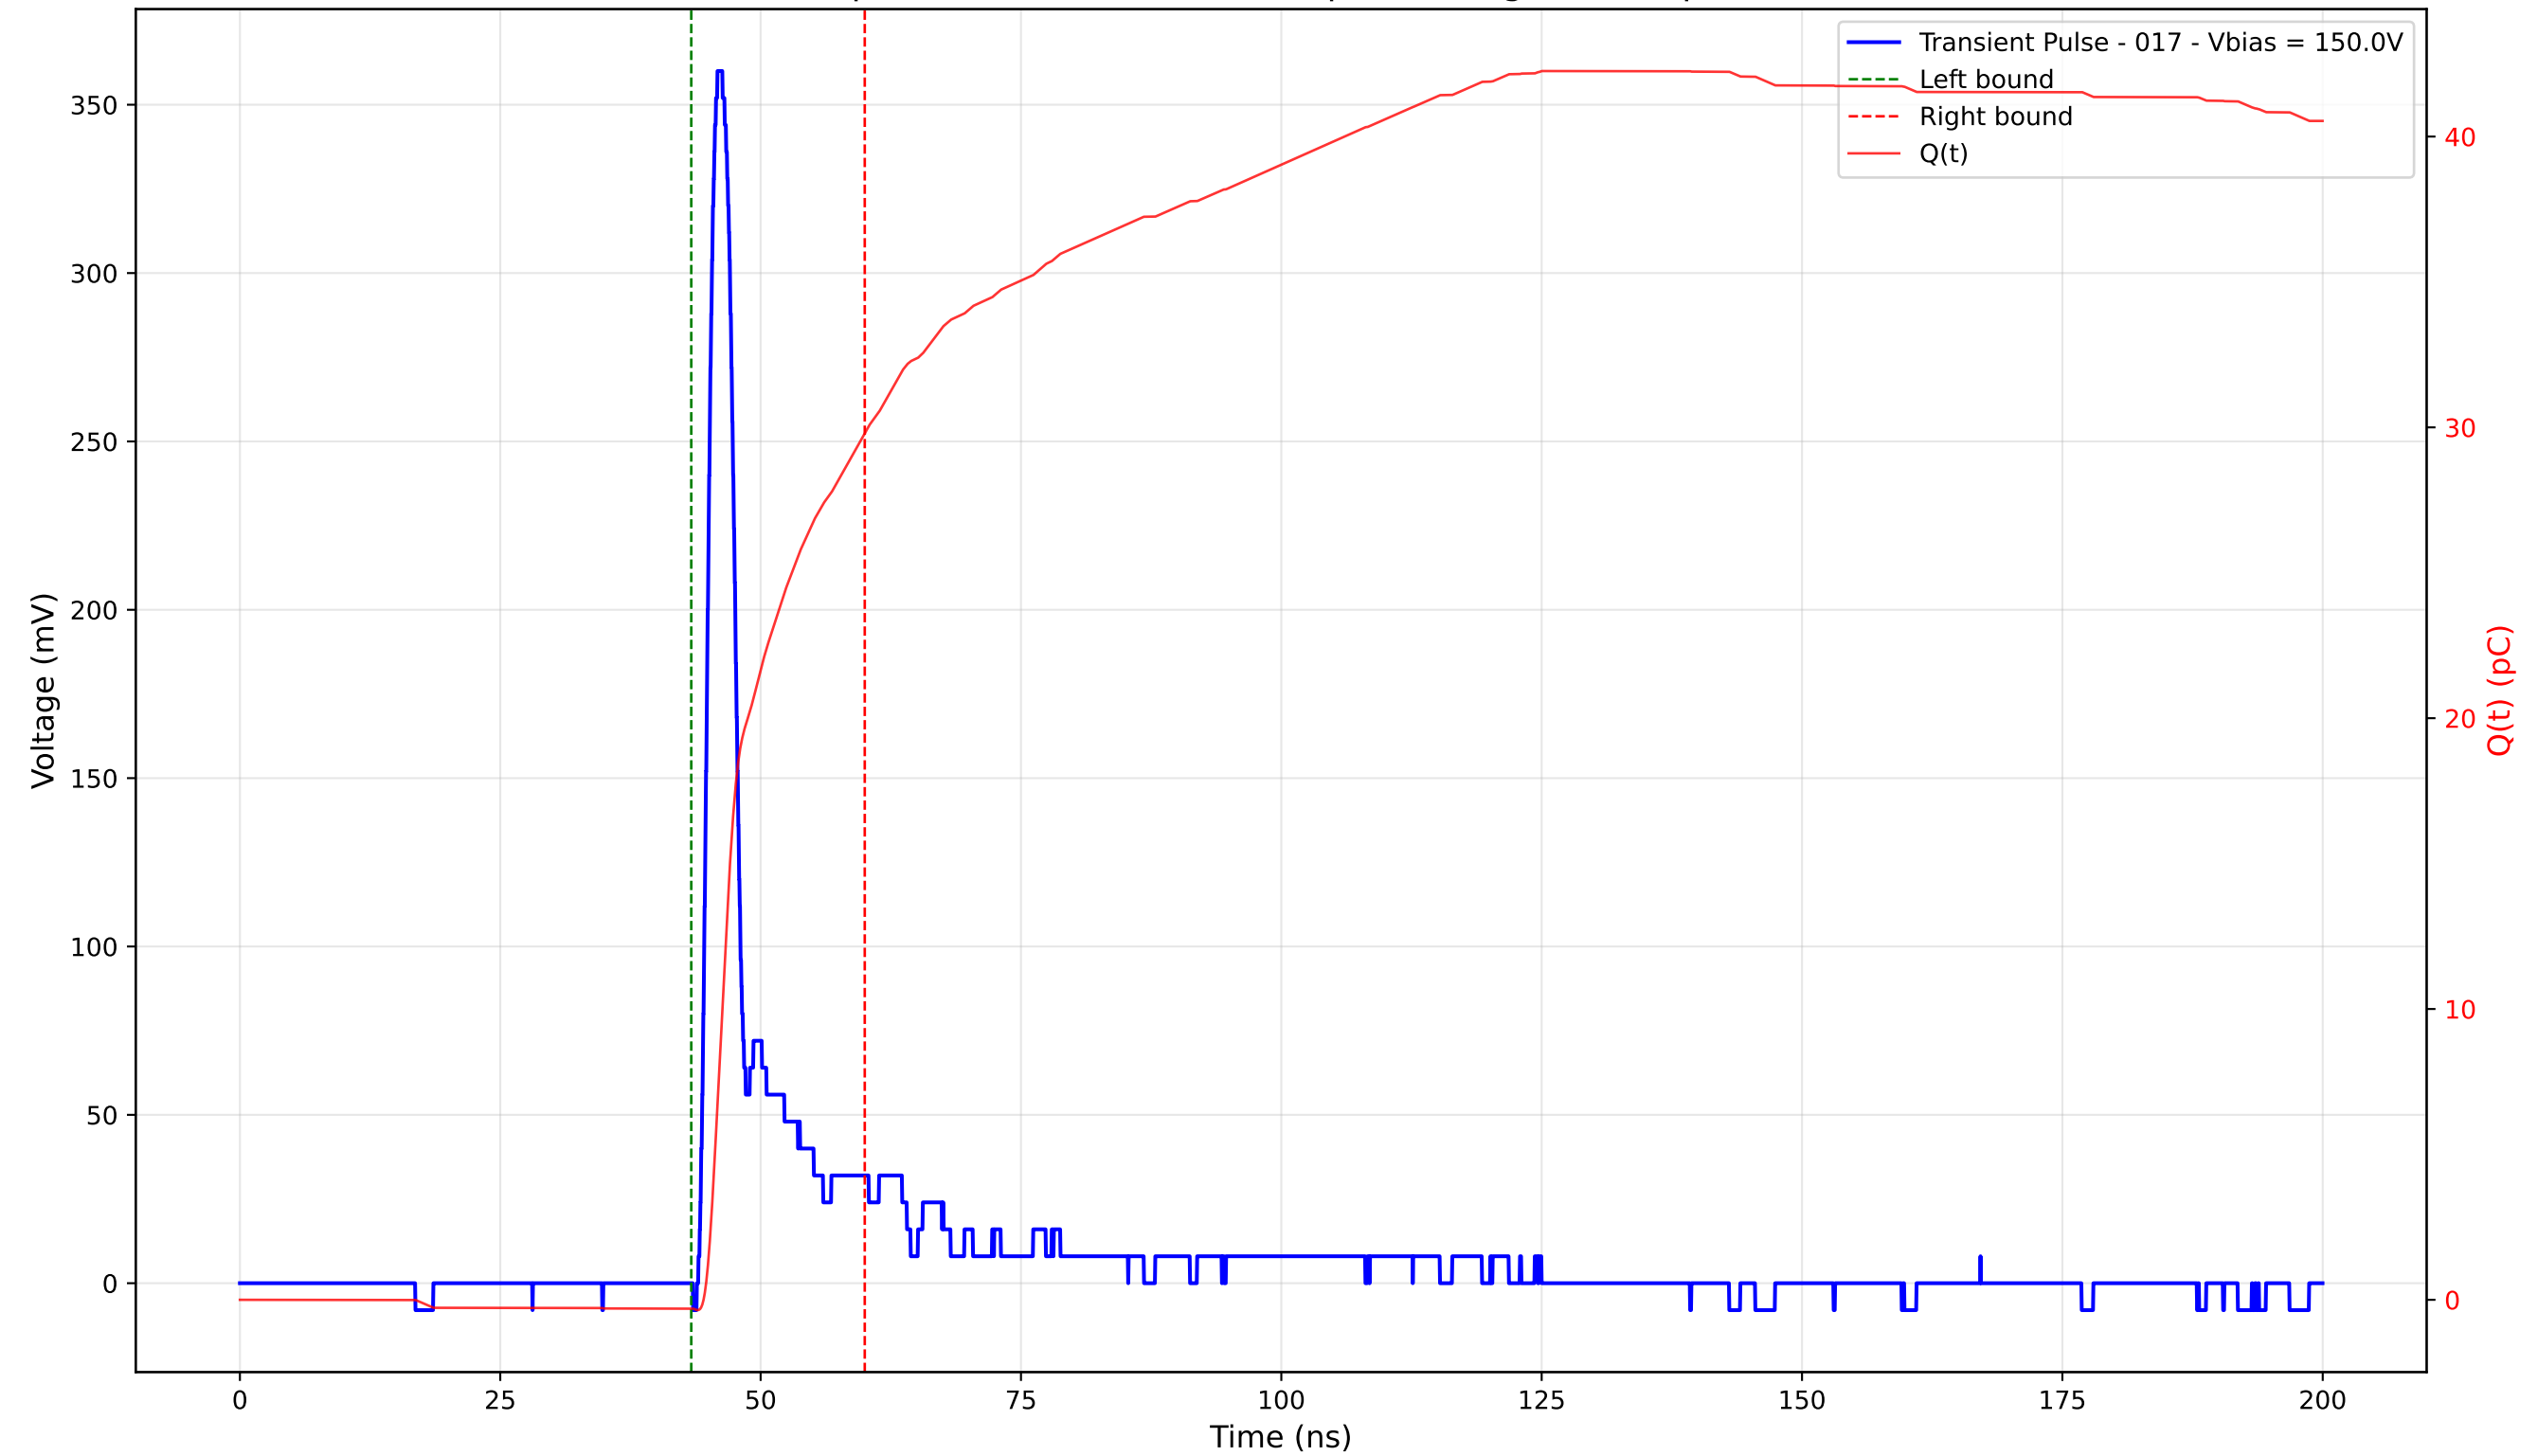


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 29.91 pC - Rise Time: 1.14 ns

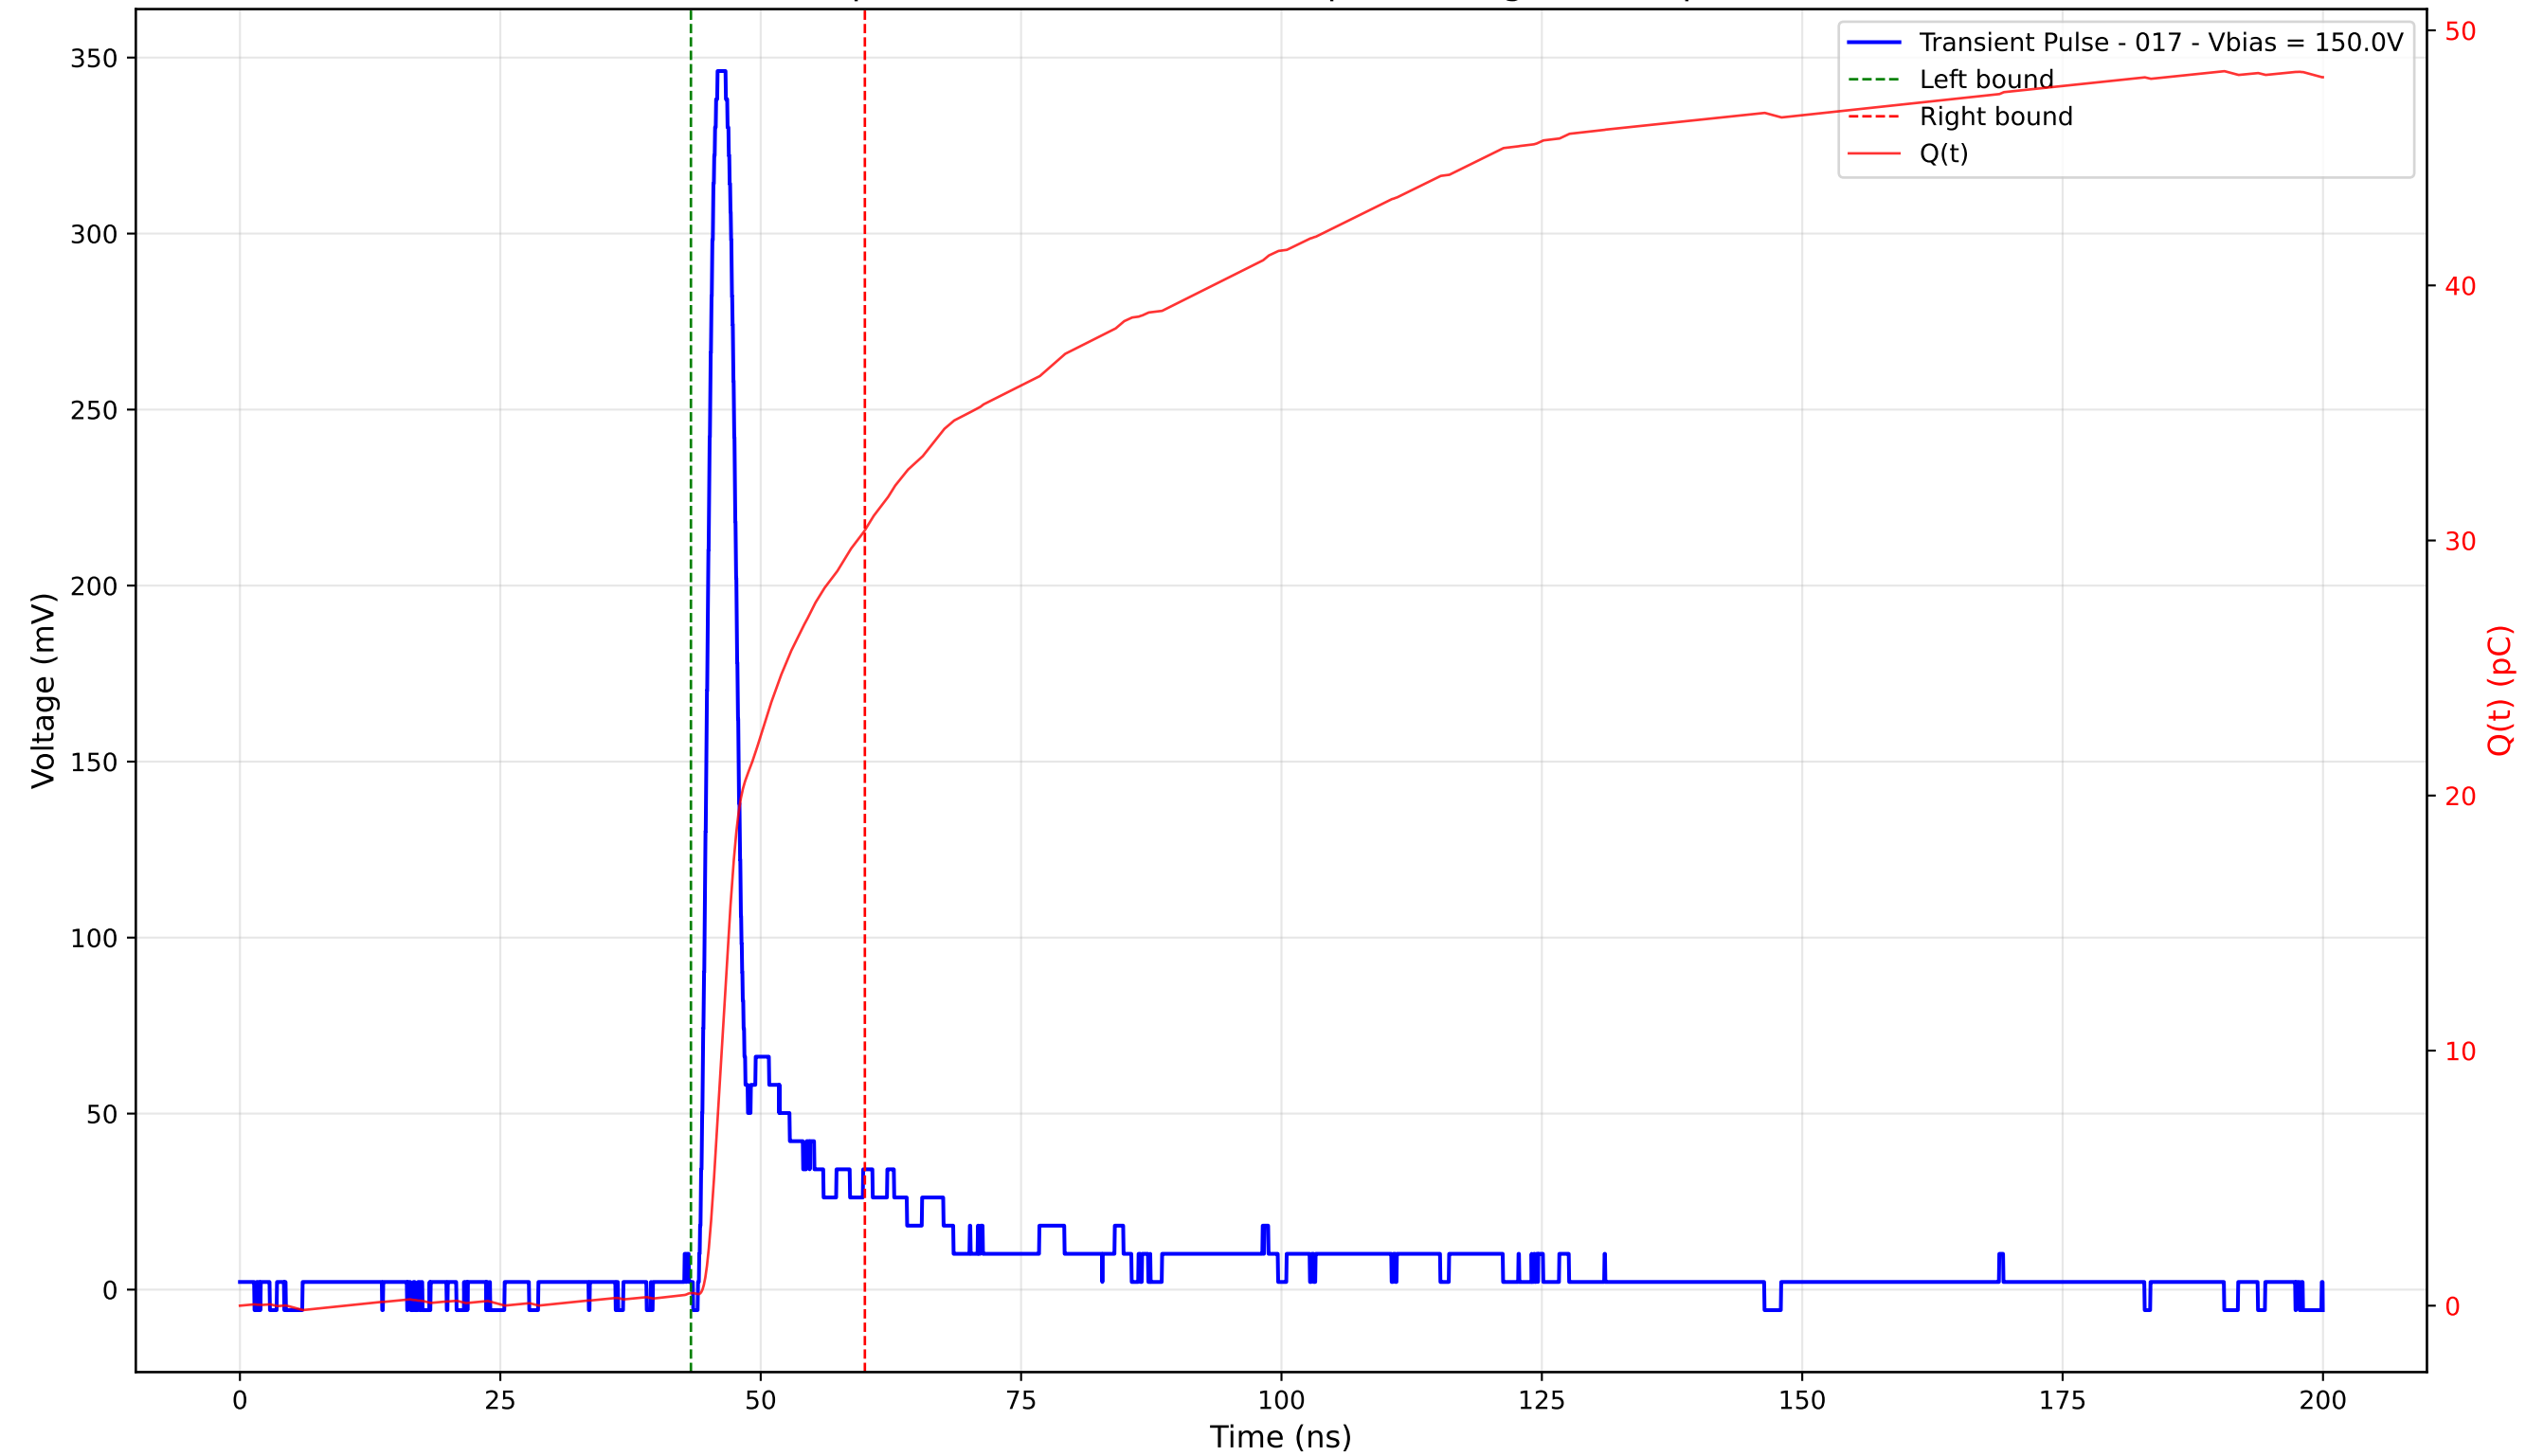


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 29.08 pC - Rise Time: 1.17 ns

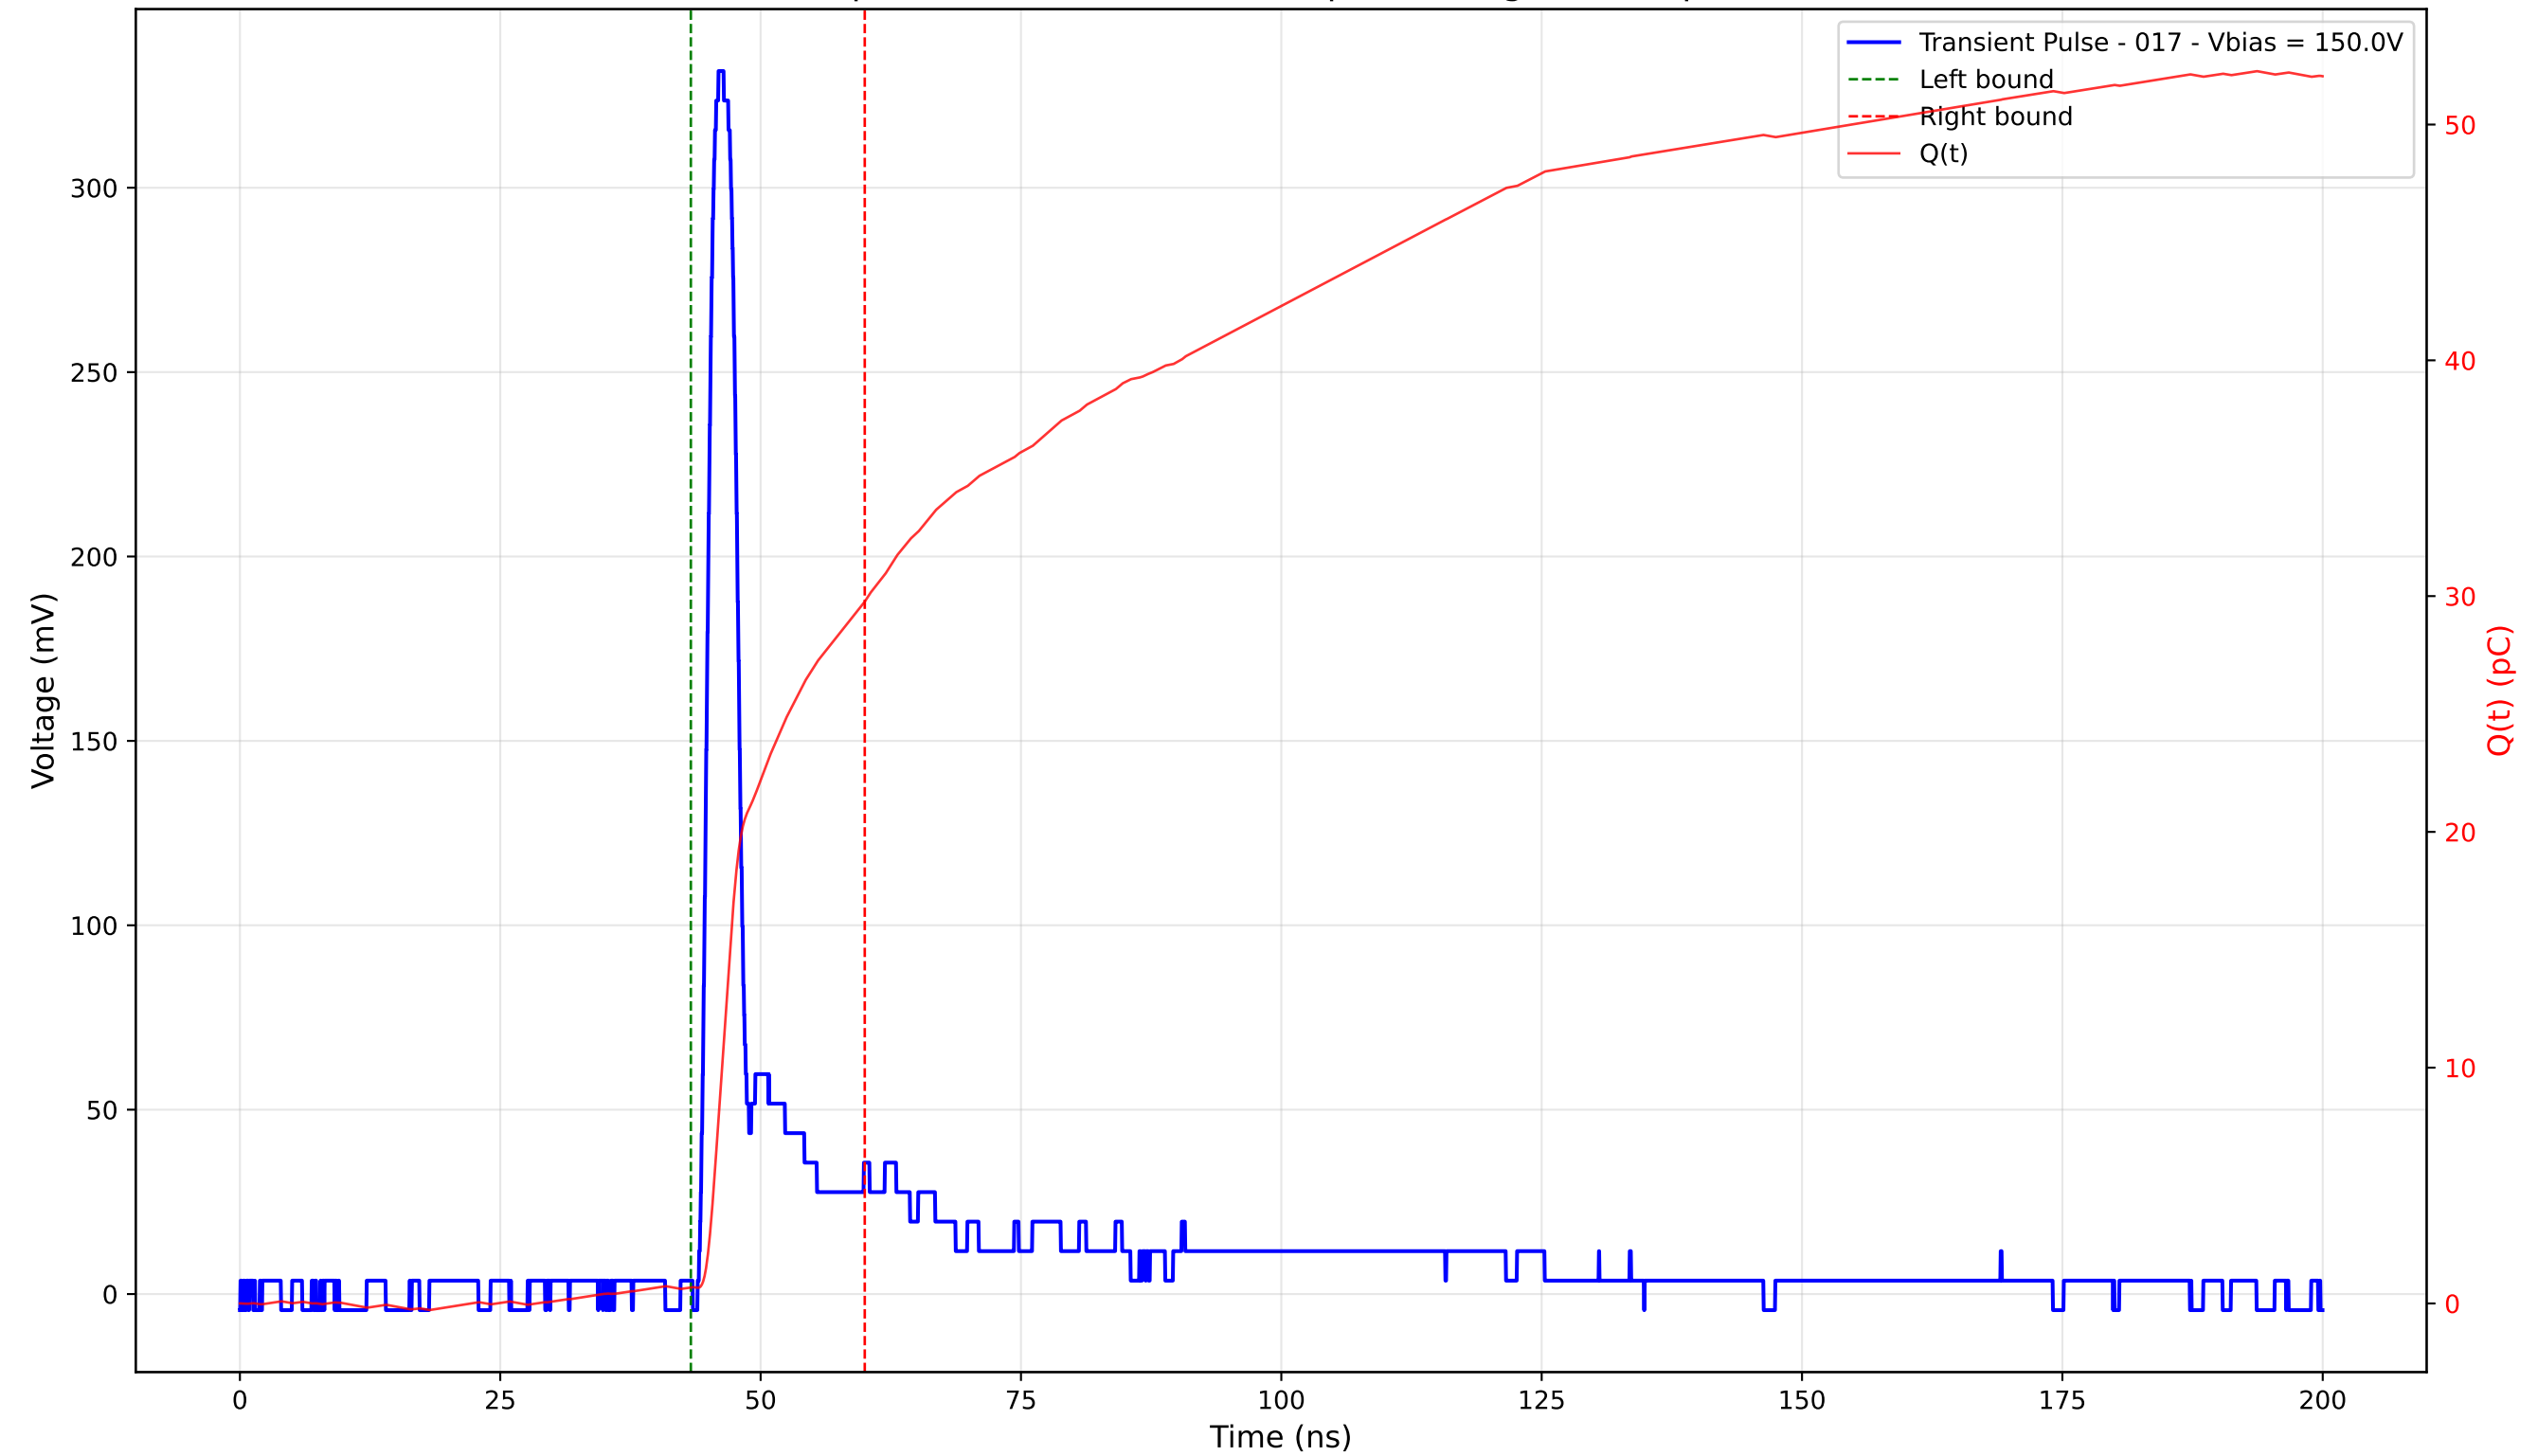


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 28.58 pC - Rise Time: 1.23 ns

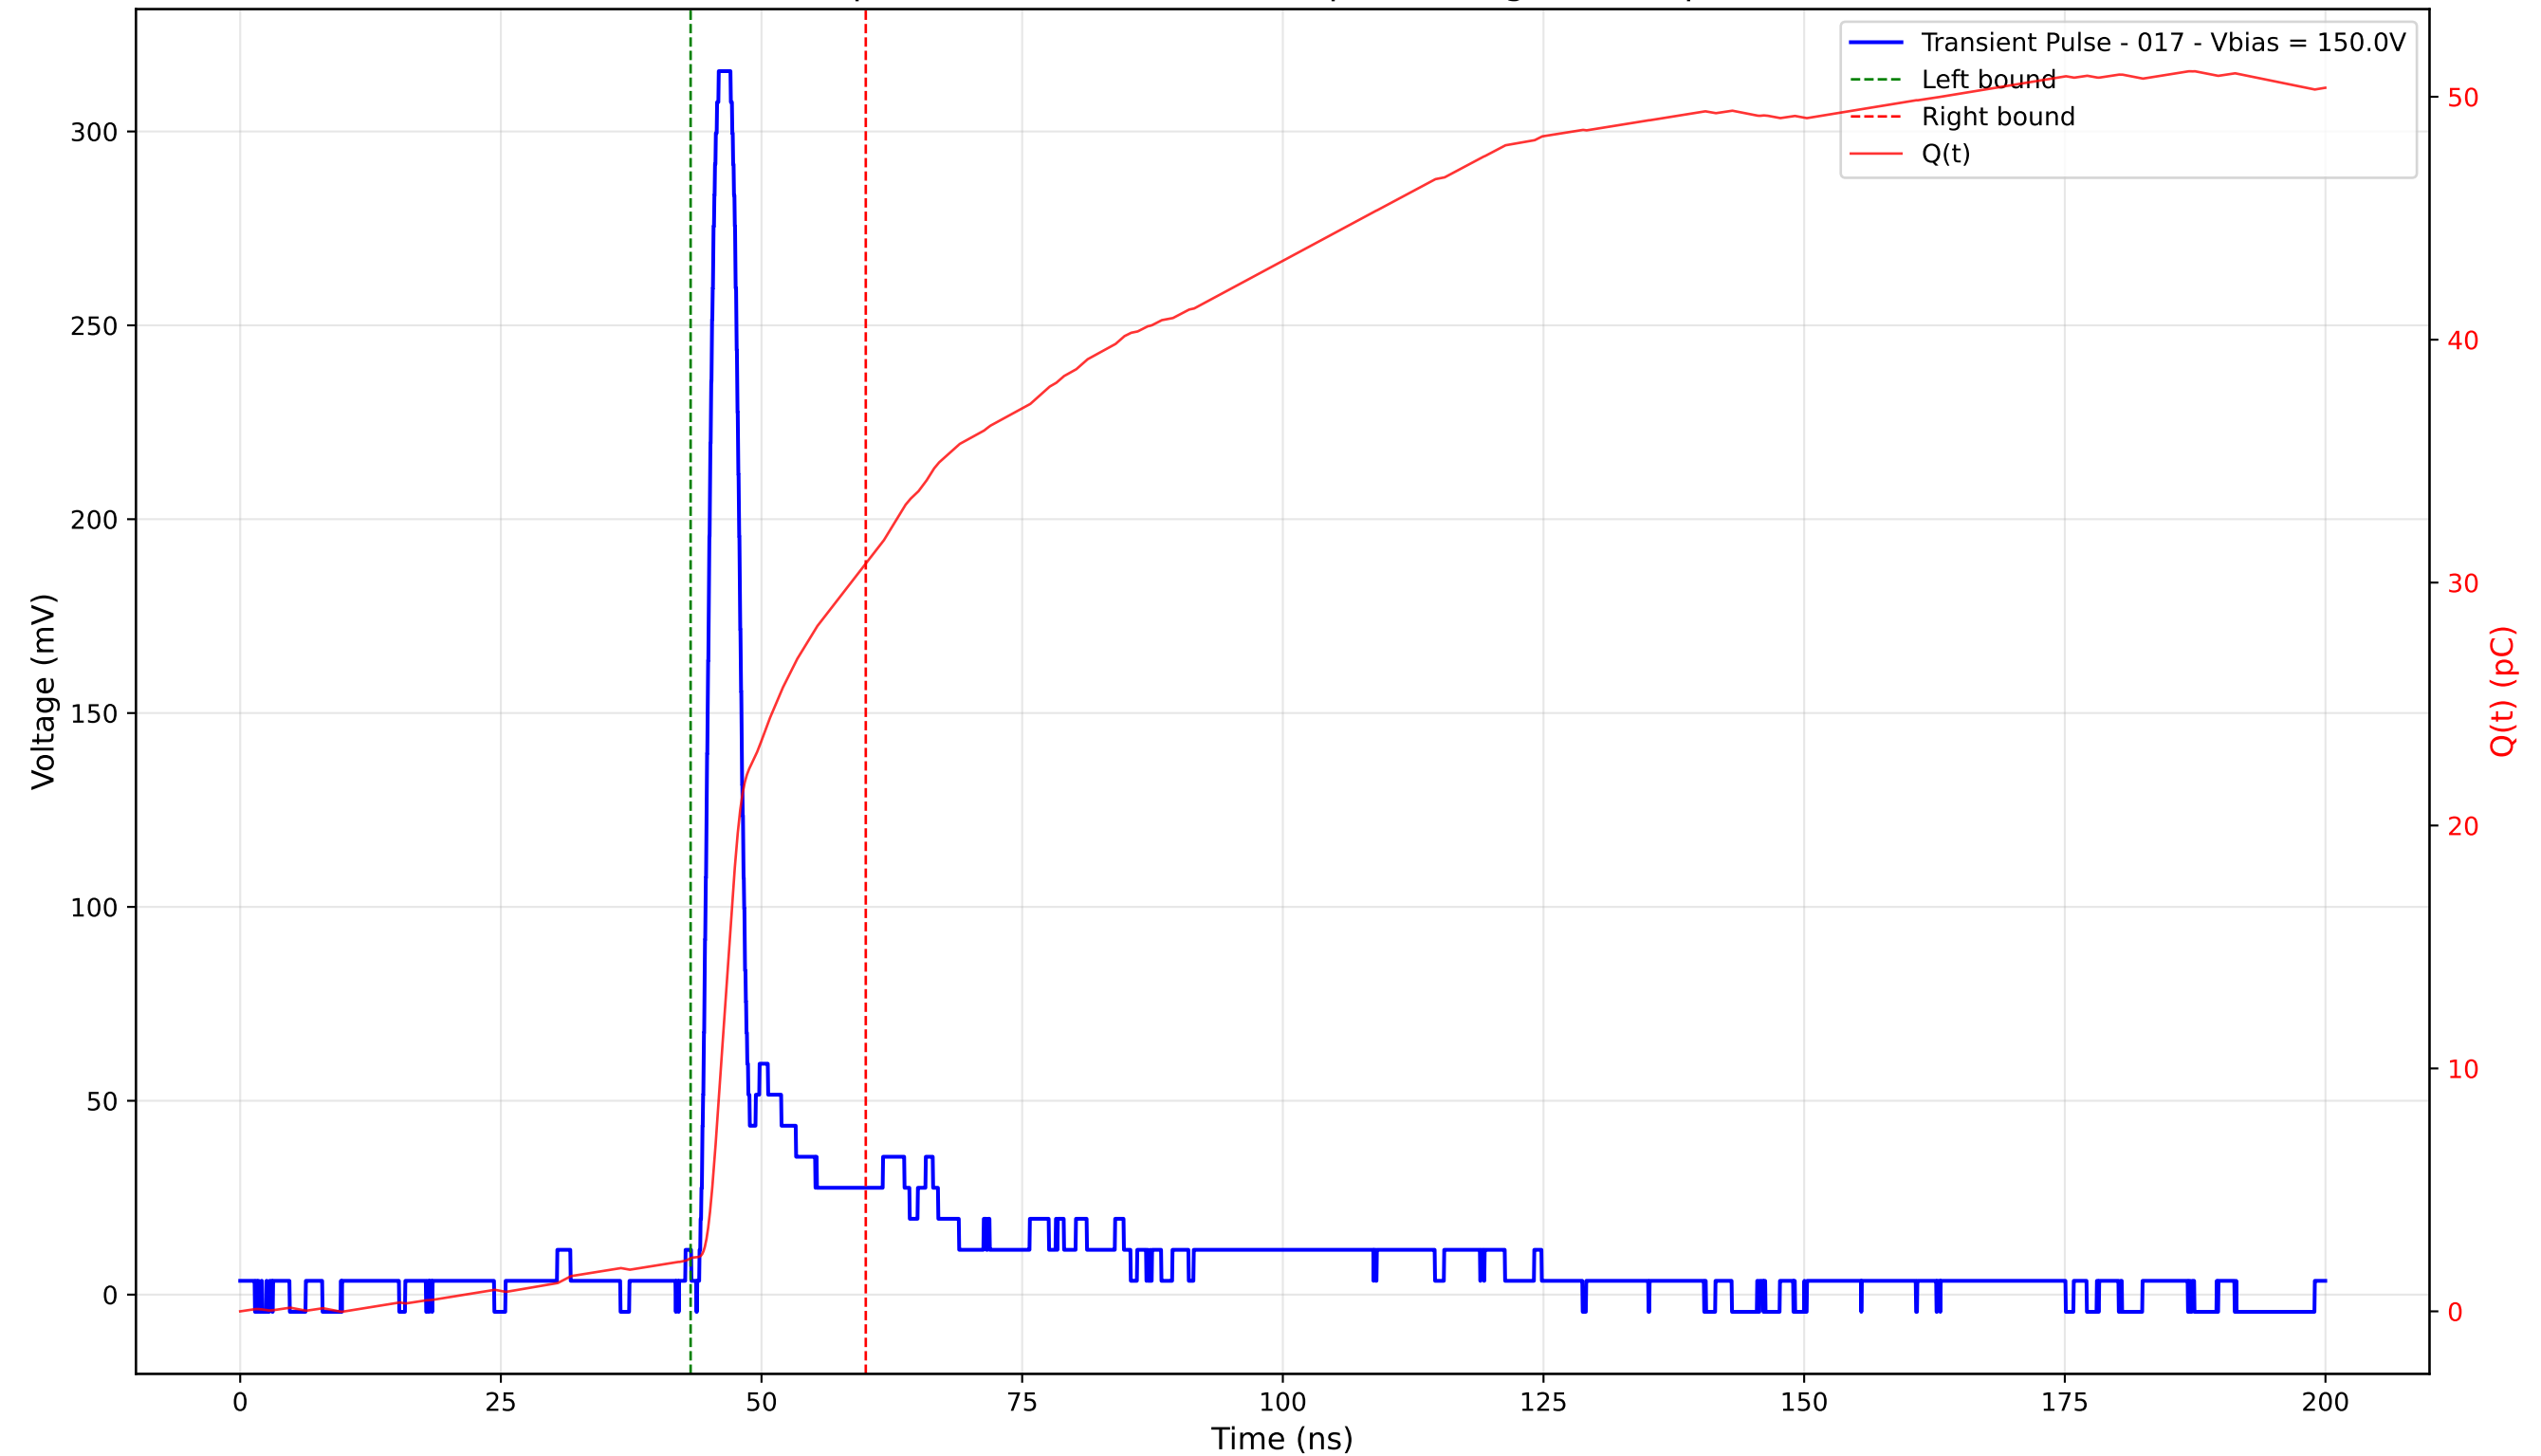


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 27.64 pC - Rise Time: 1.24 ns

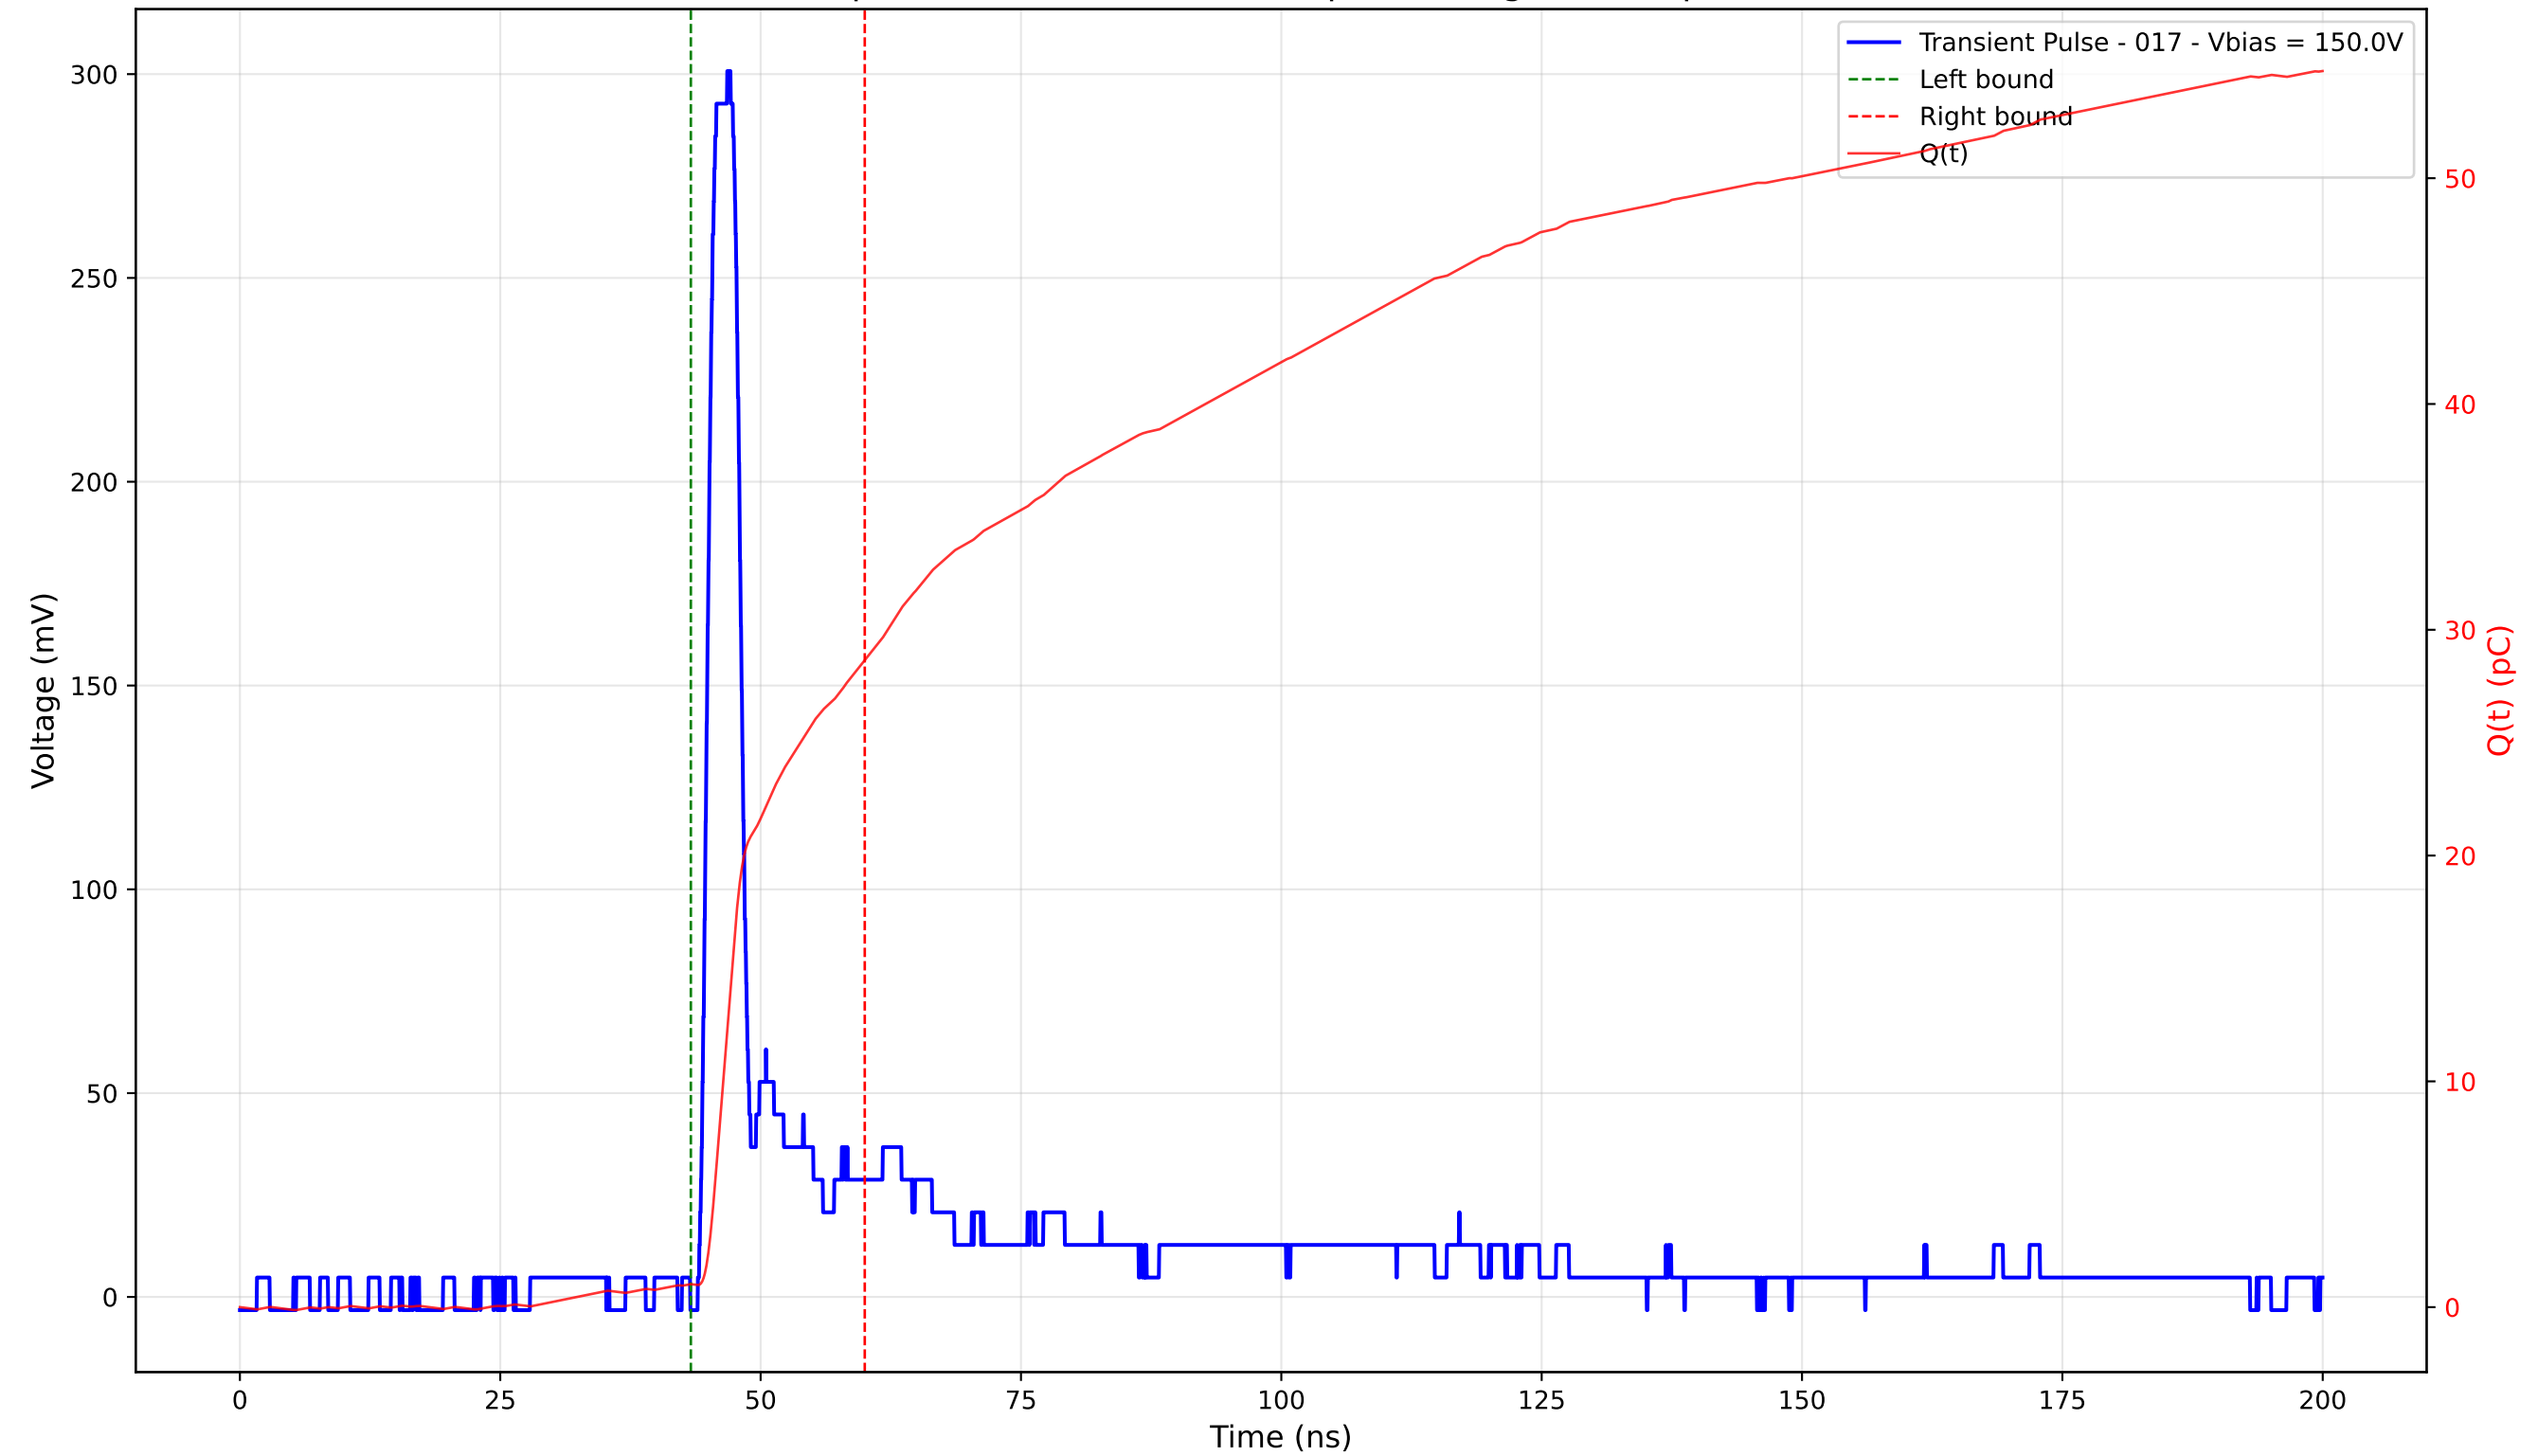


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 27.17 pC - Rise Time: 1.28 ns

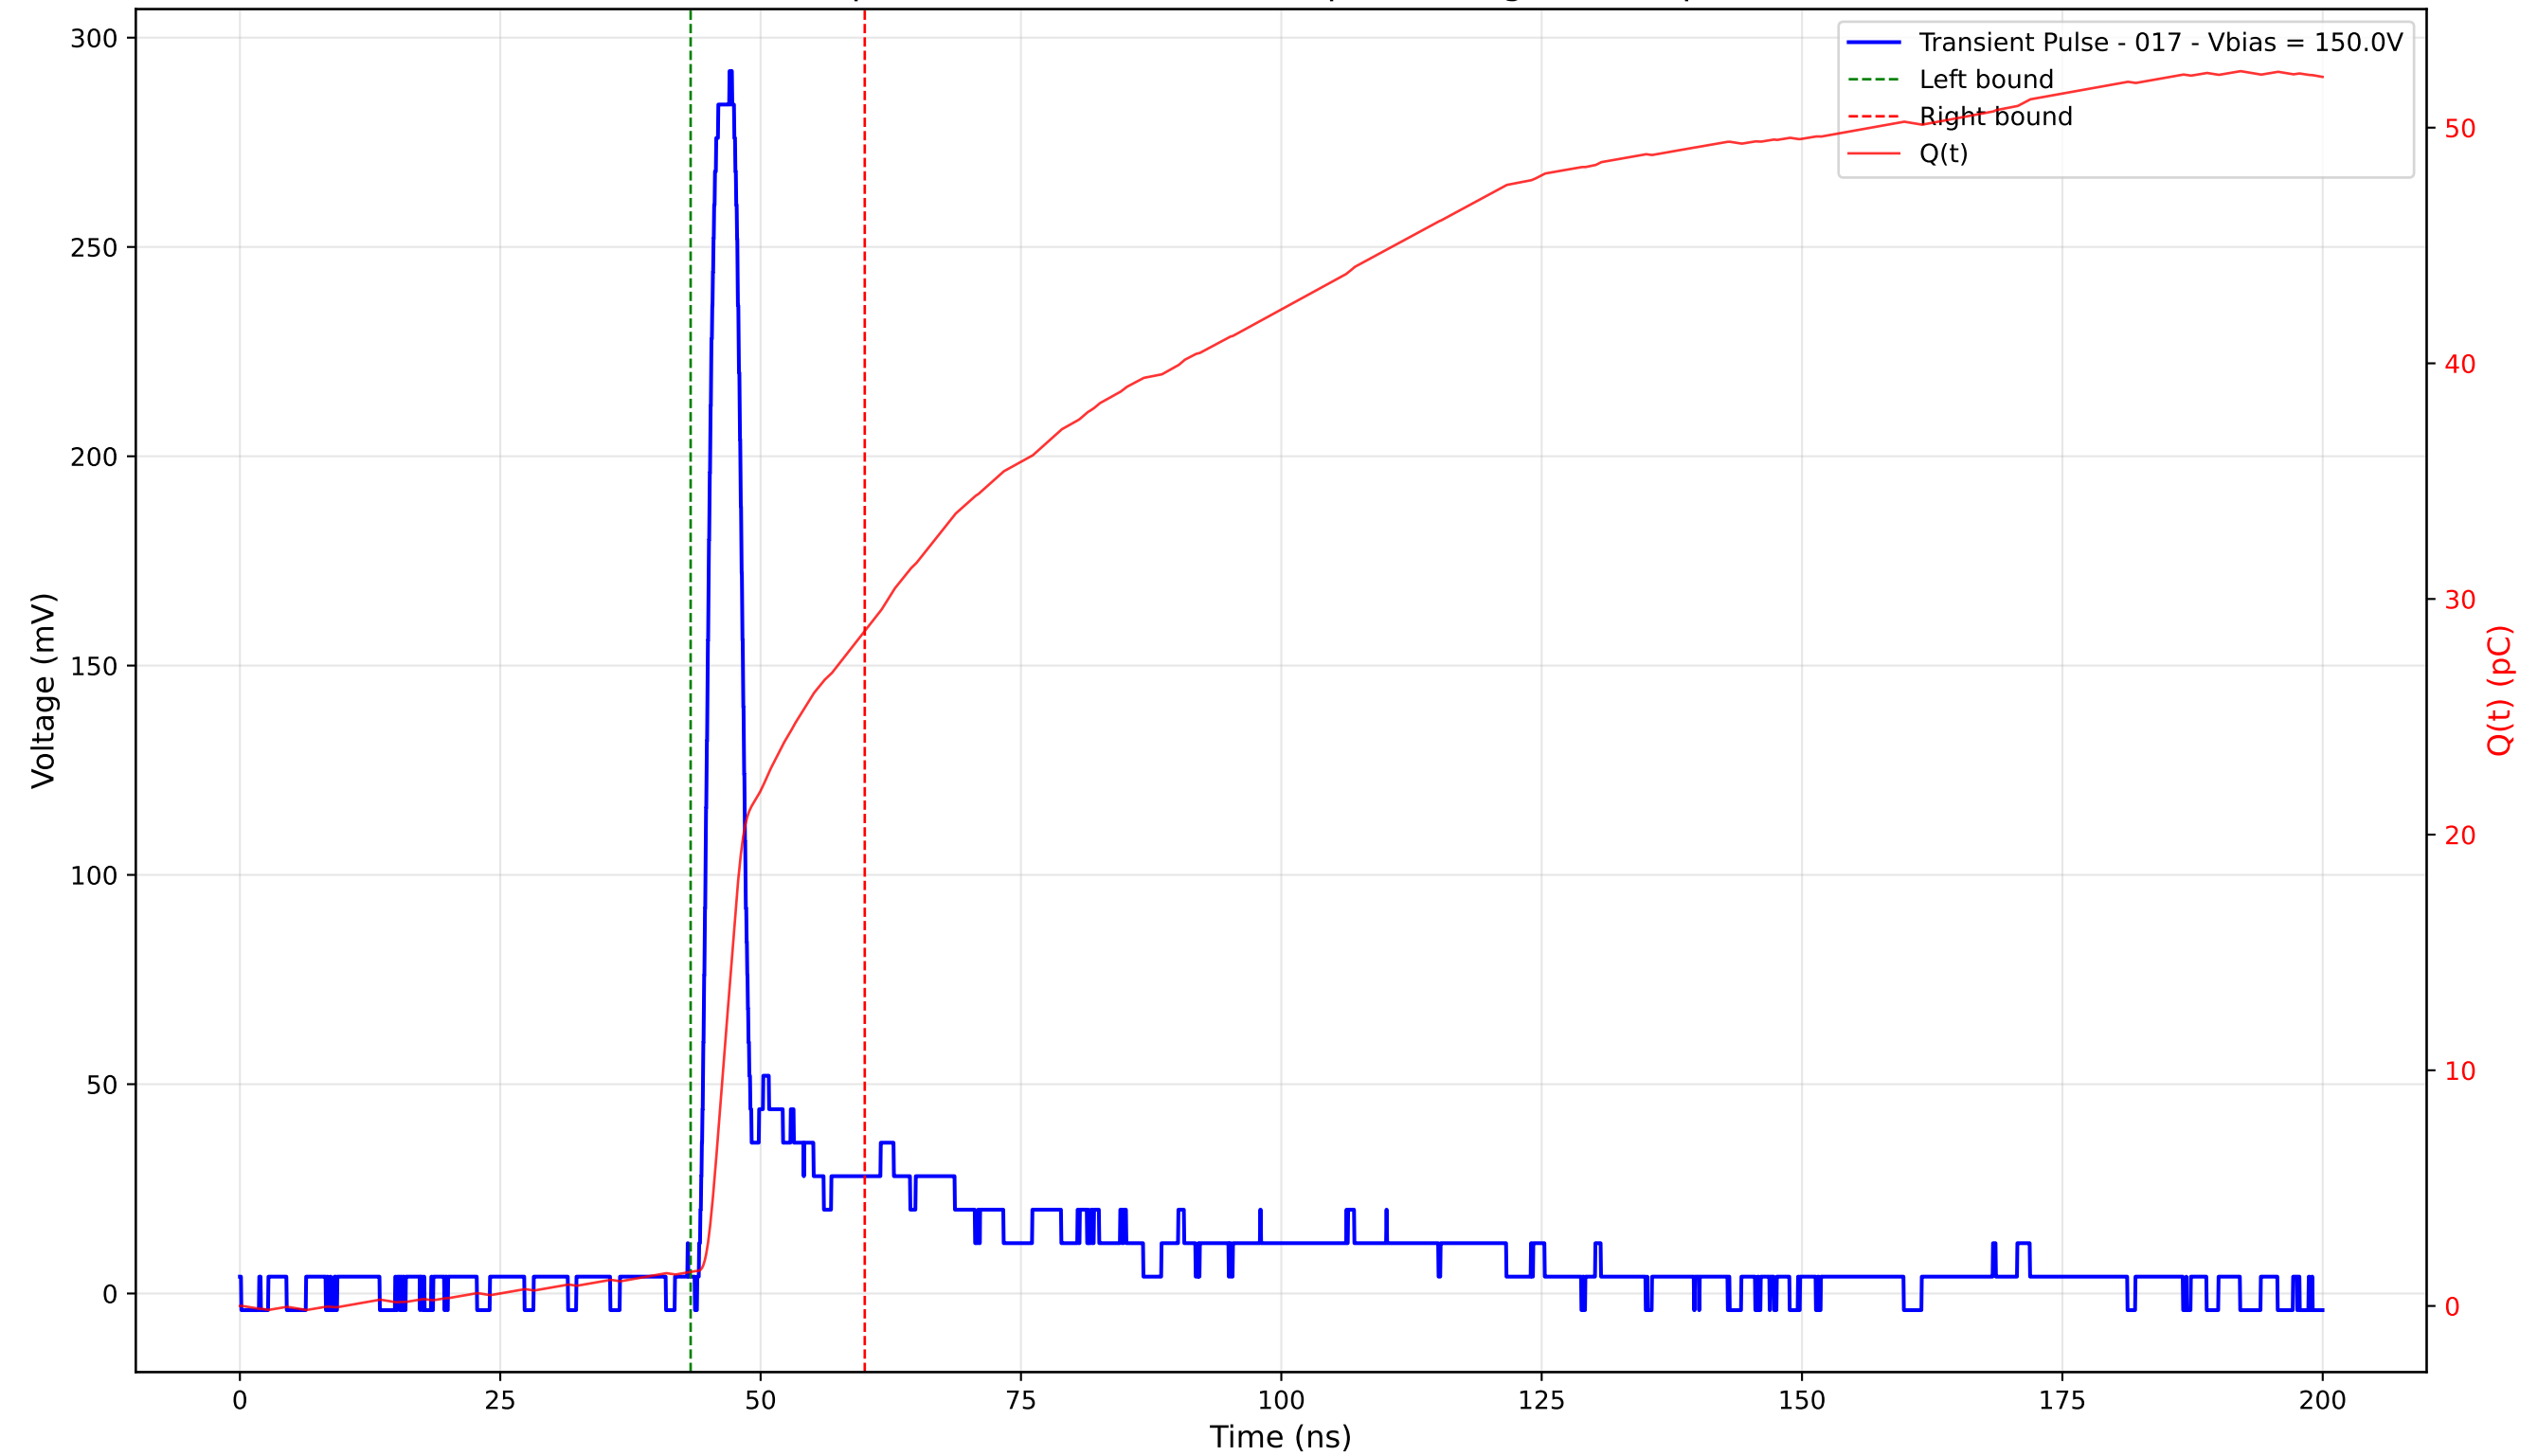


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 24.90 pC - Rise Time: 1.38 ns

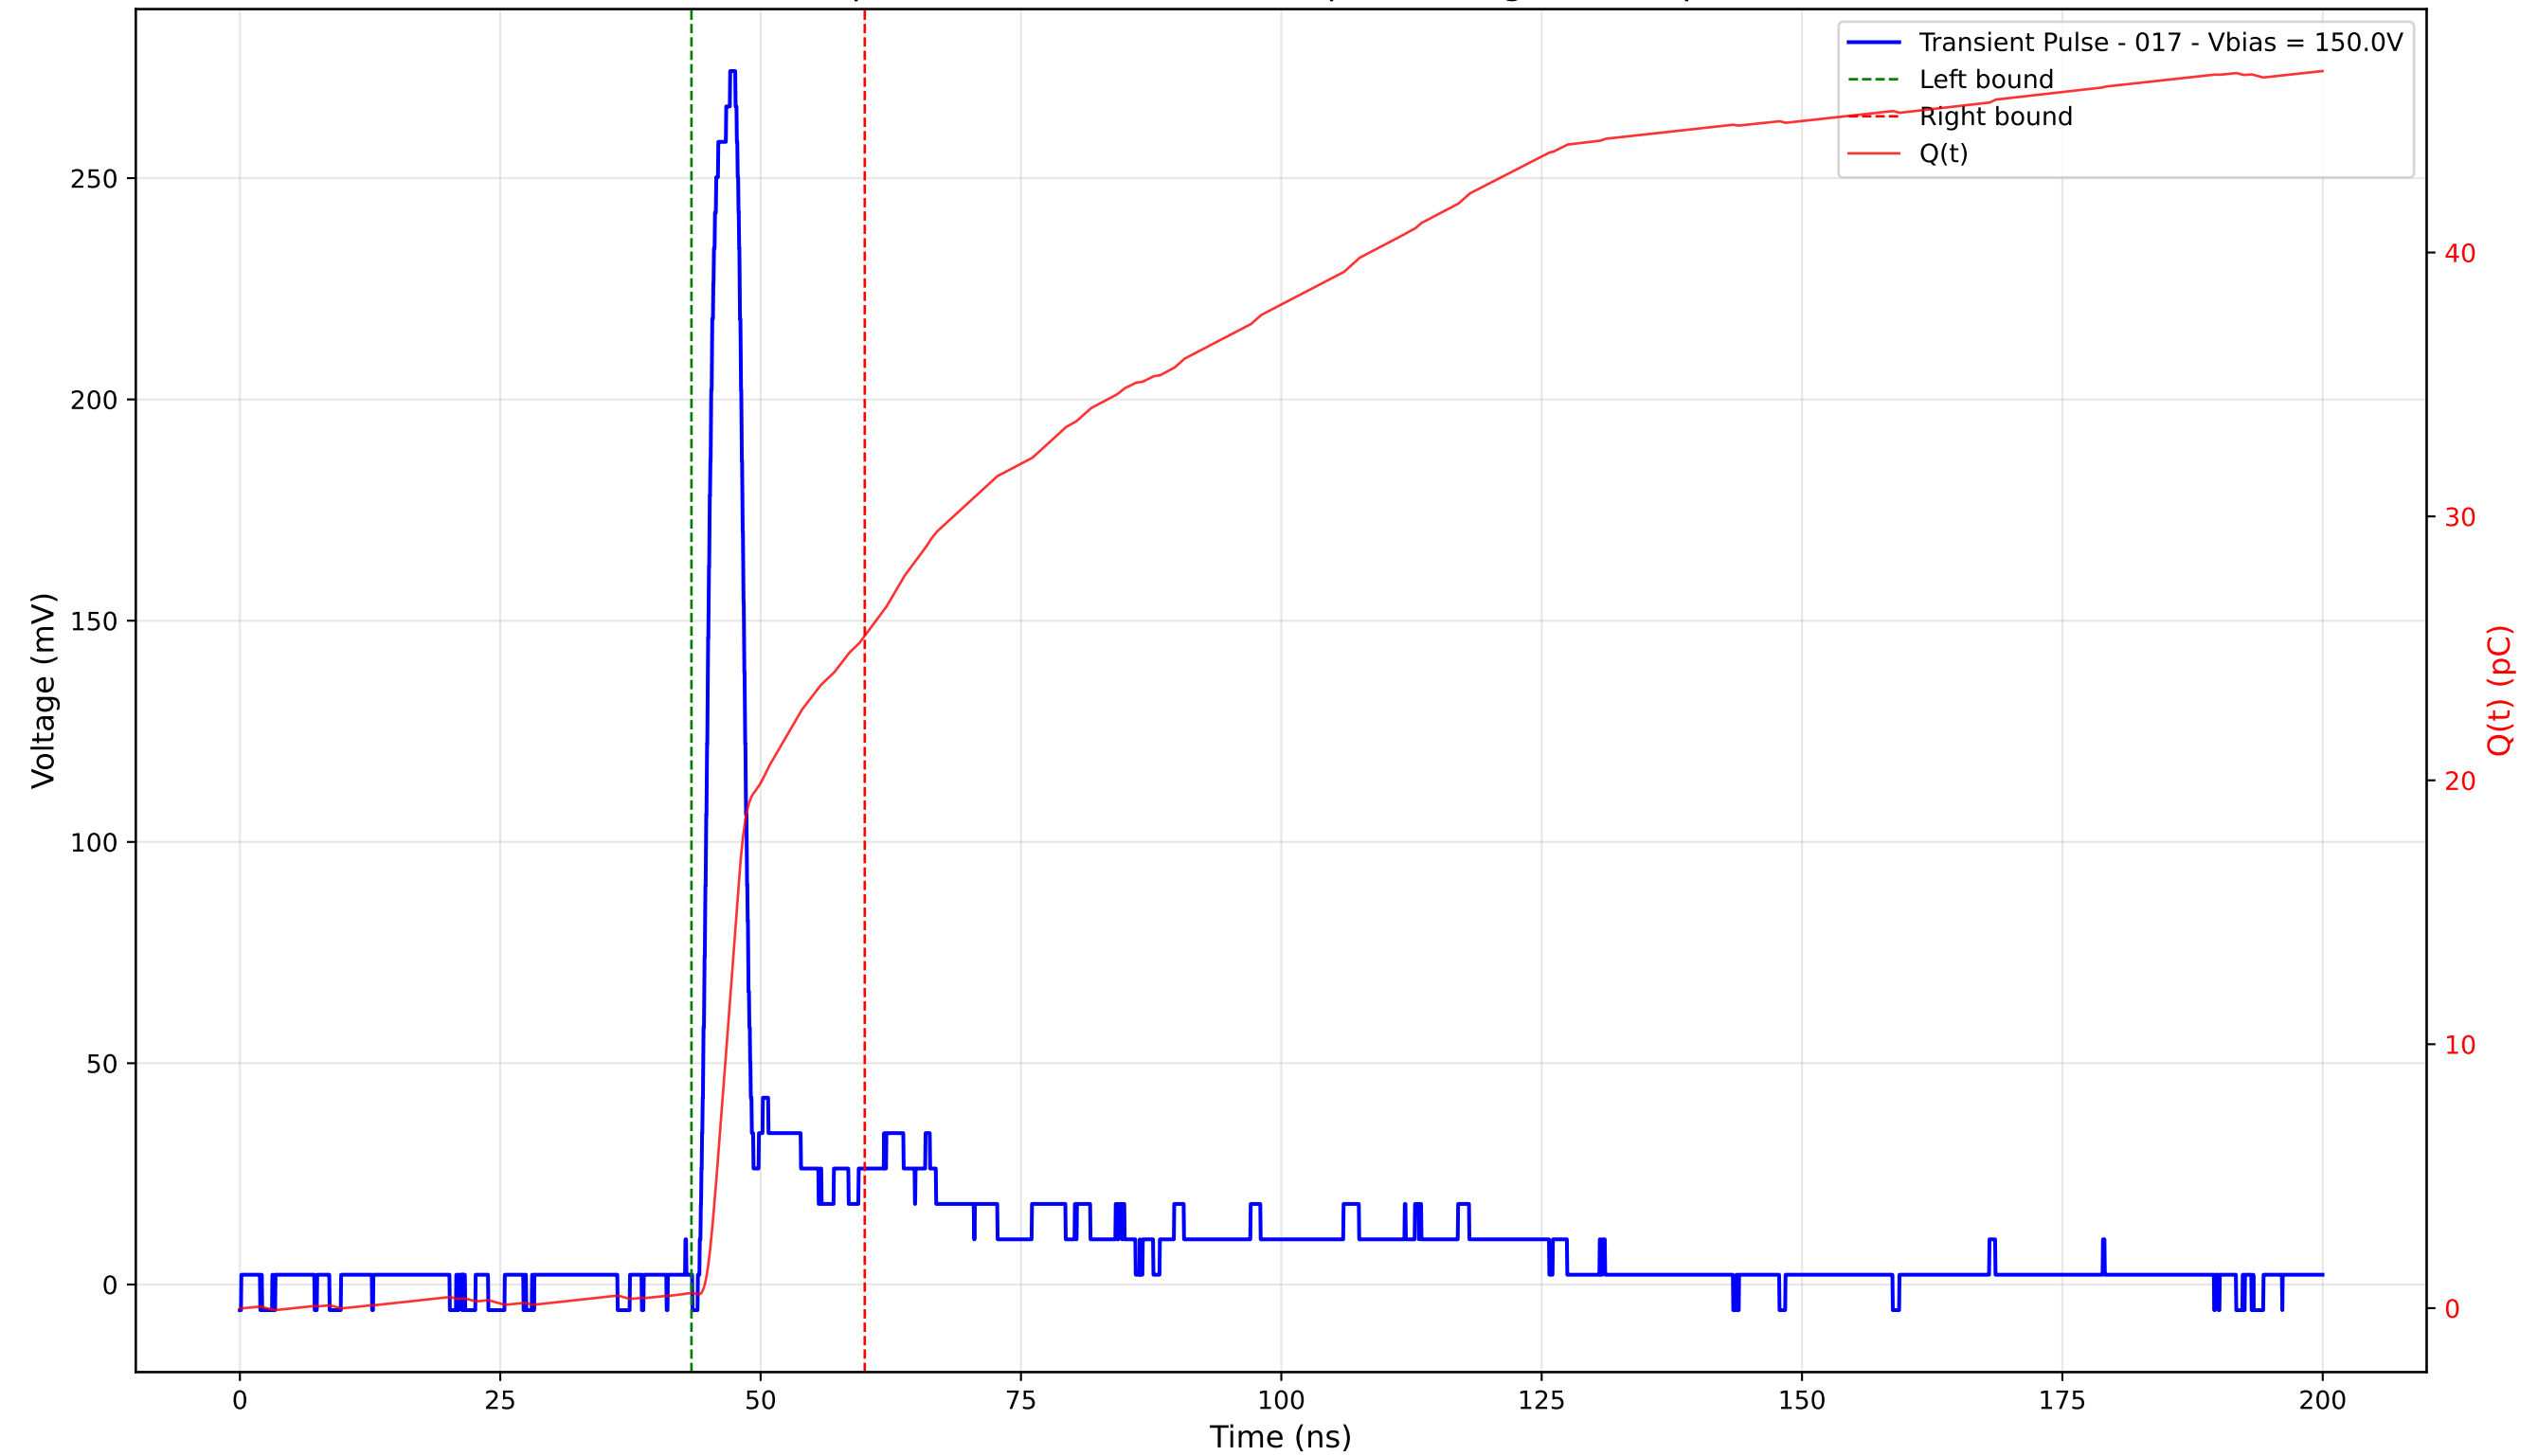


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 24.83 pC - Rise Time: 1.48 ns

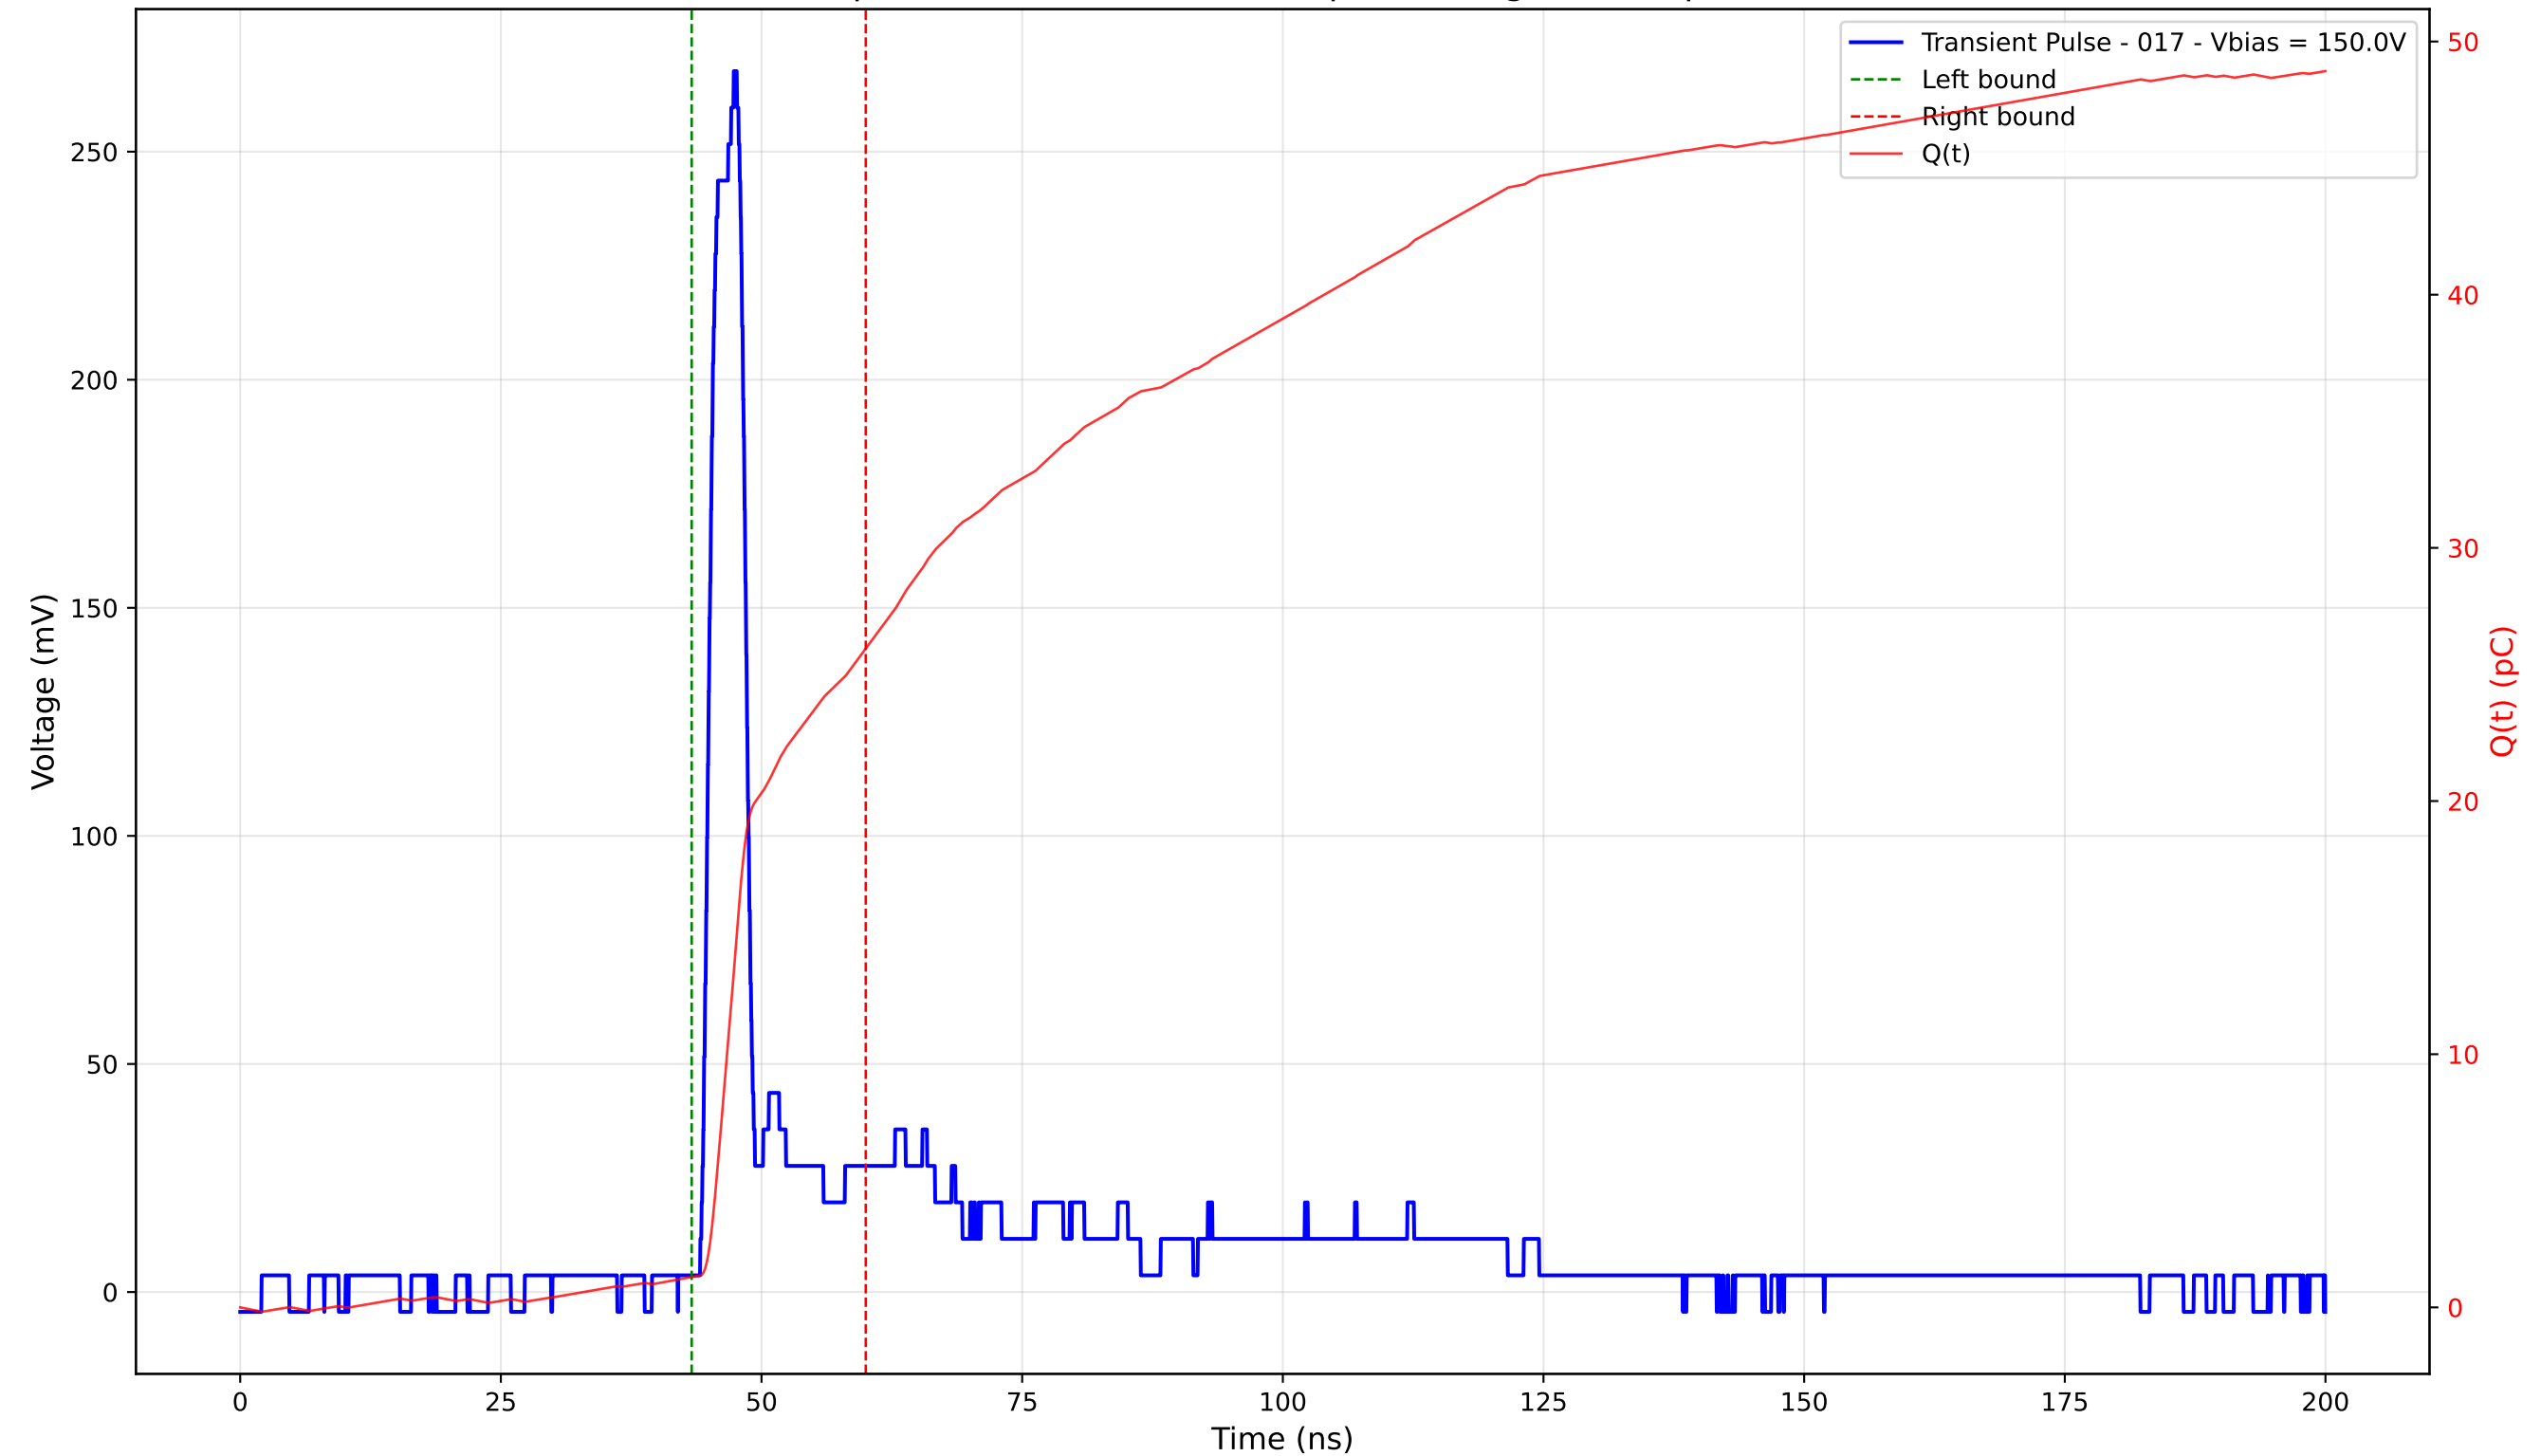


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 23.14 pC - Rise Time: 2.53 ns

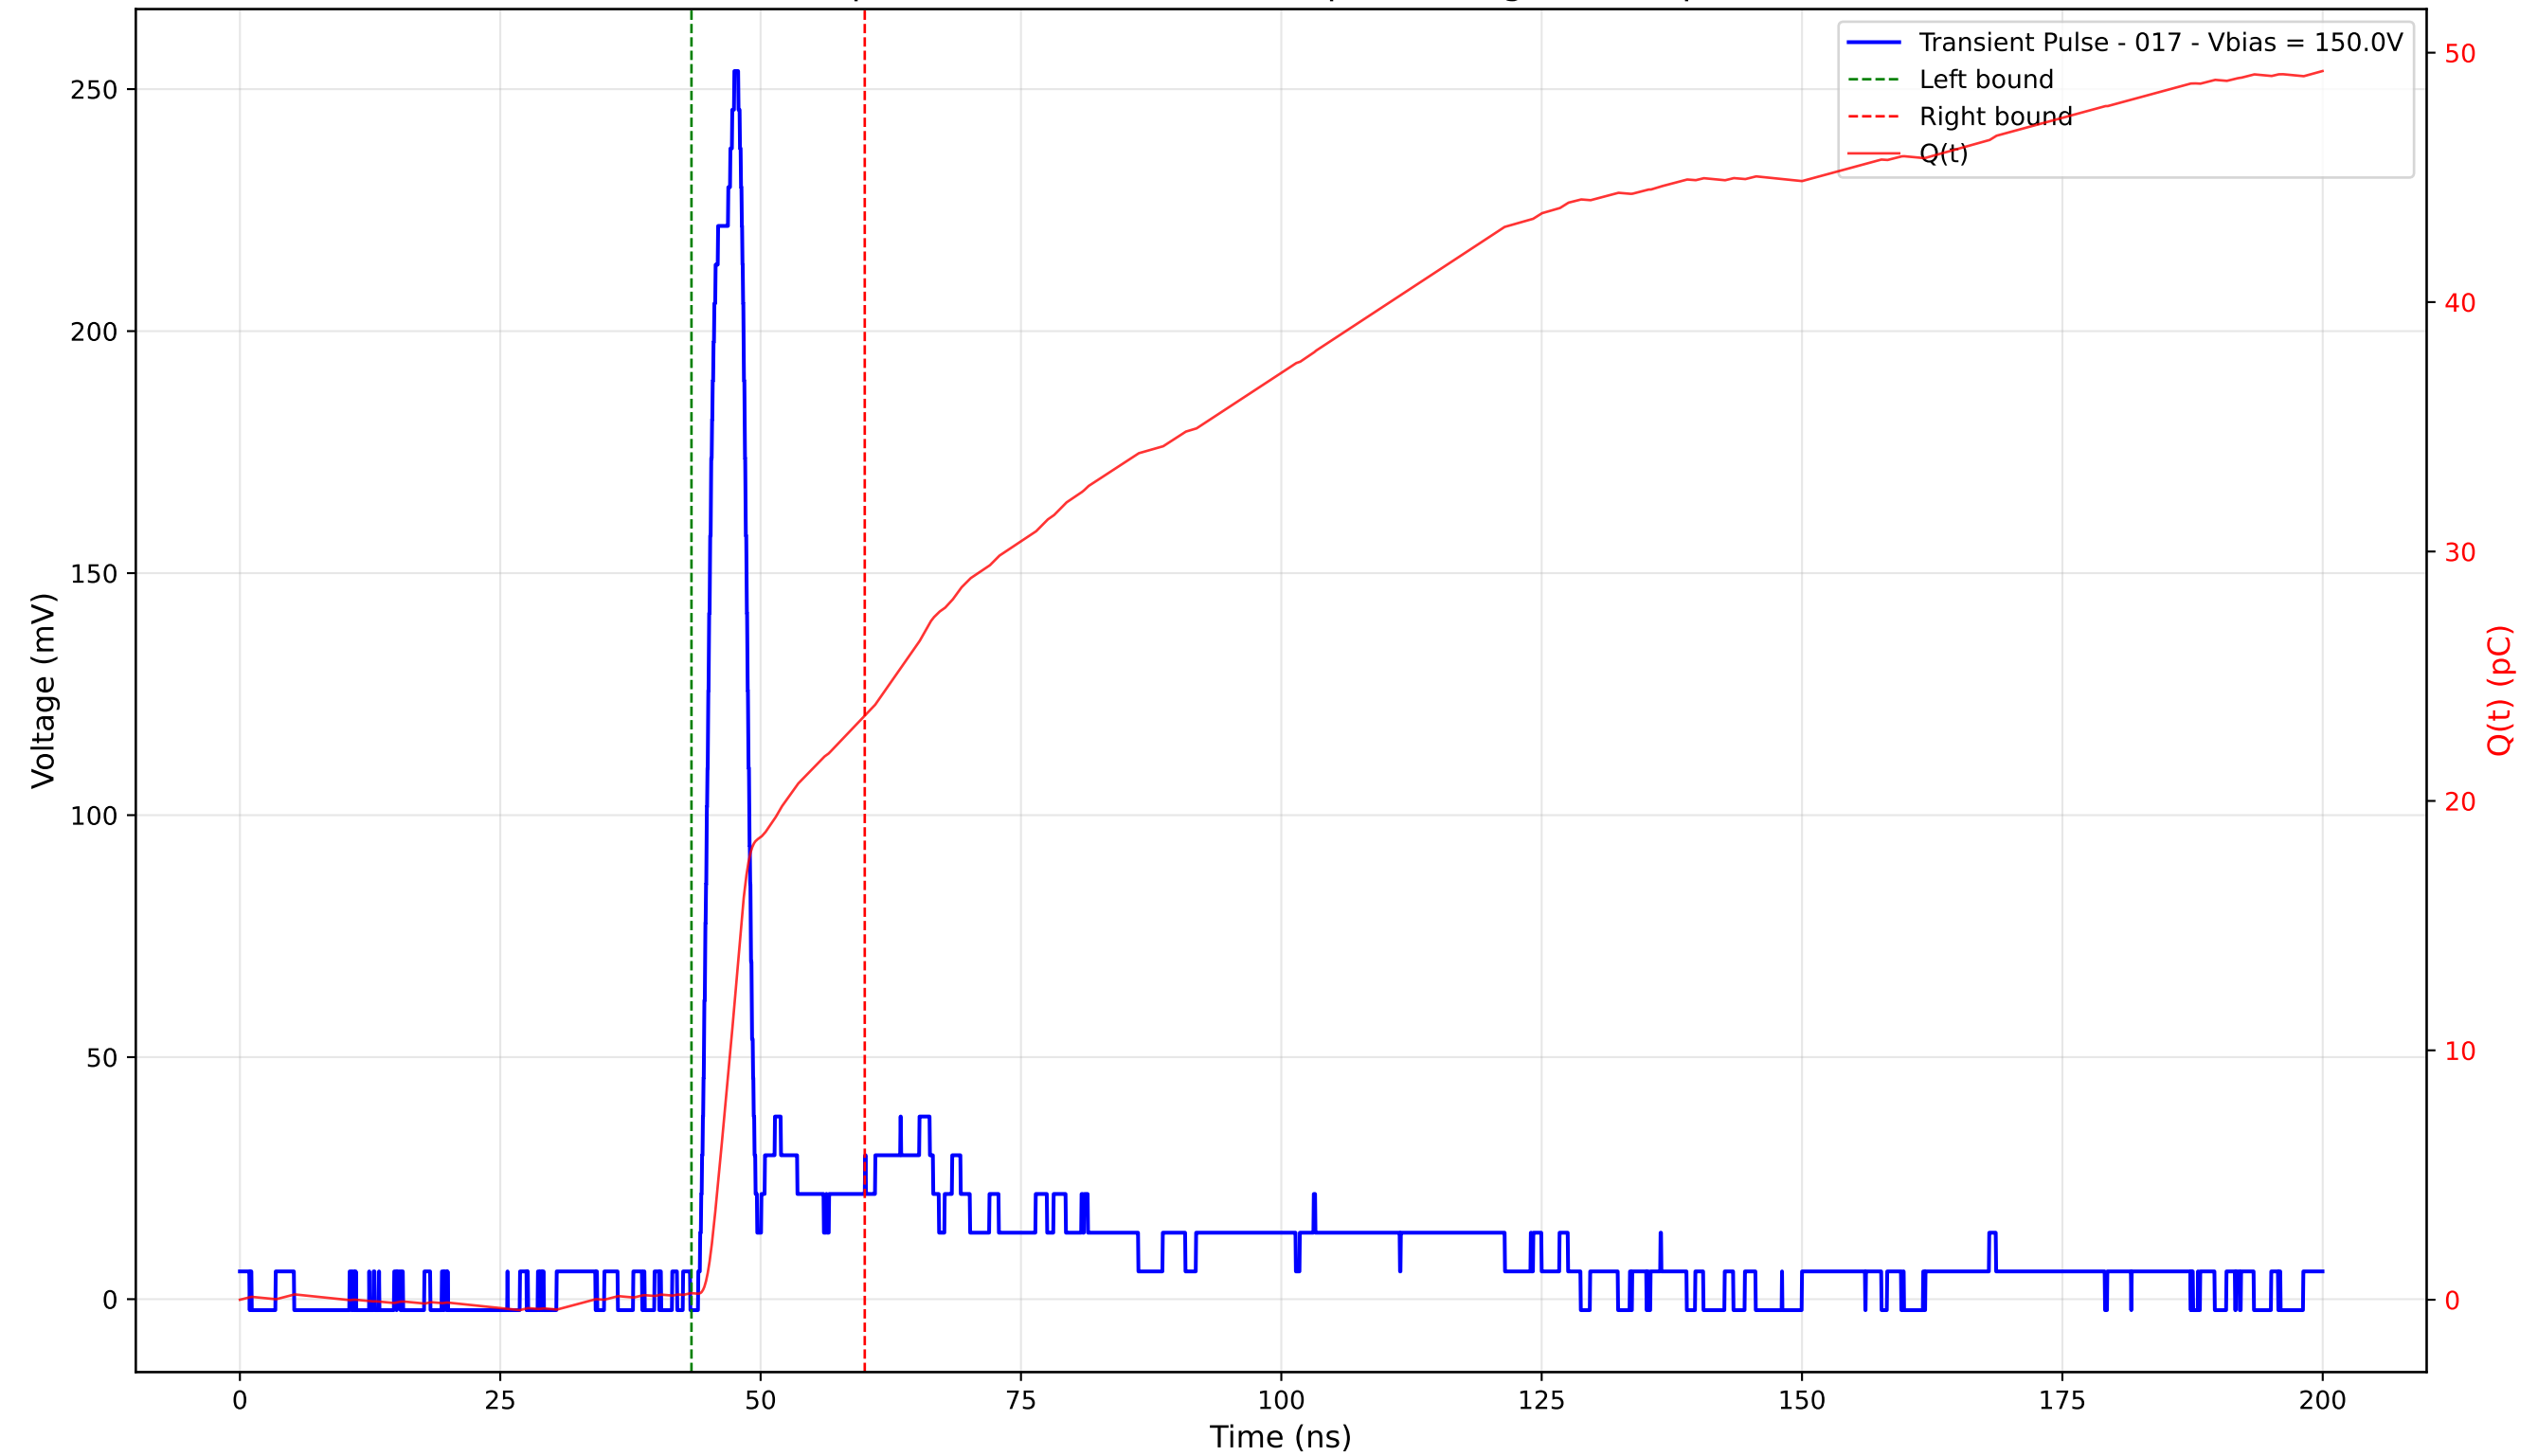


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 20.64 pC - Rise Time: 2.55 ns

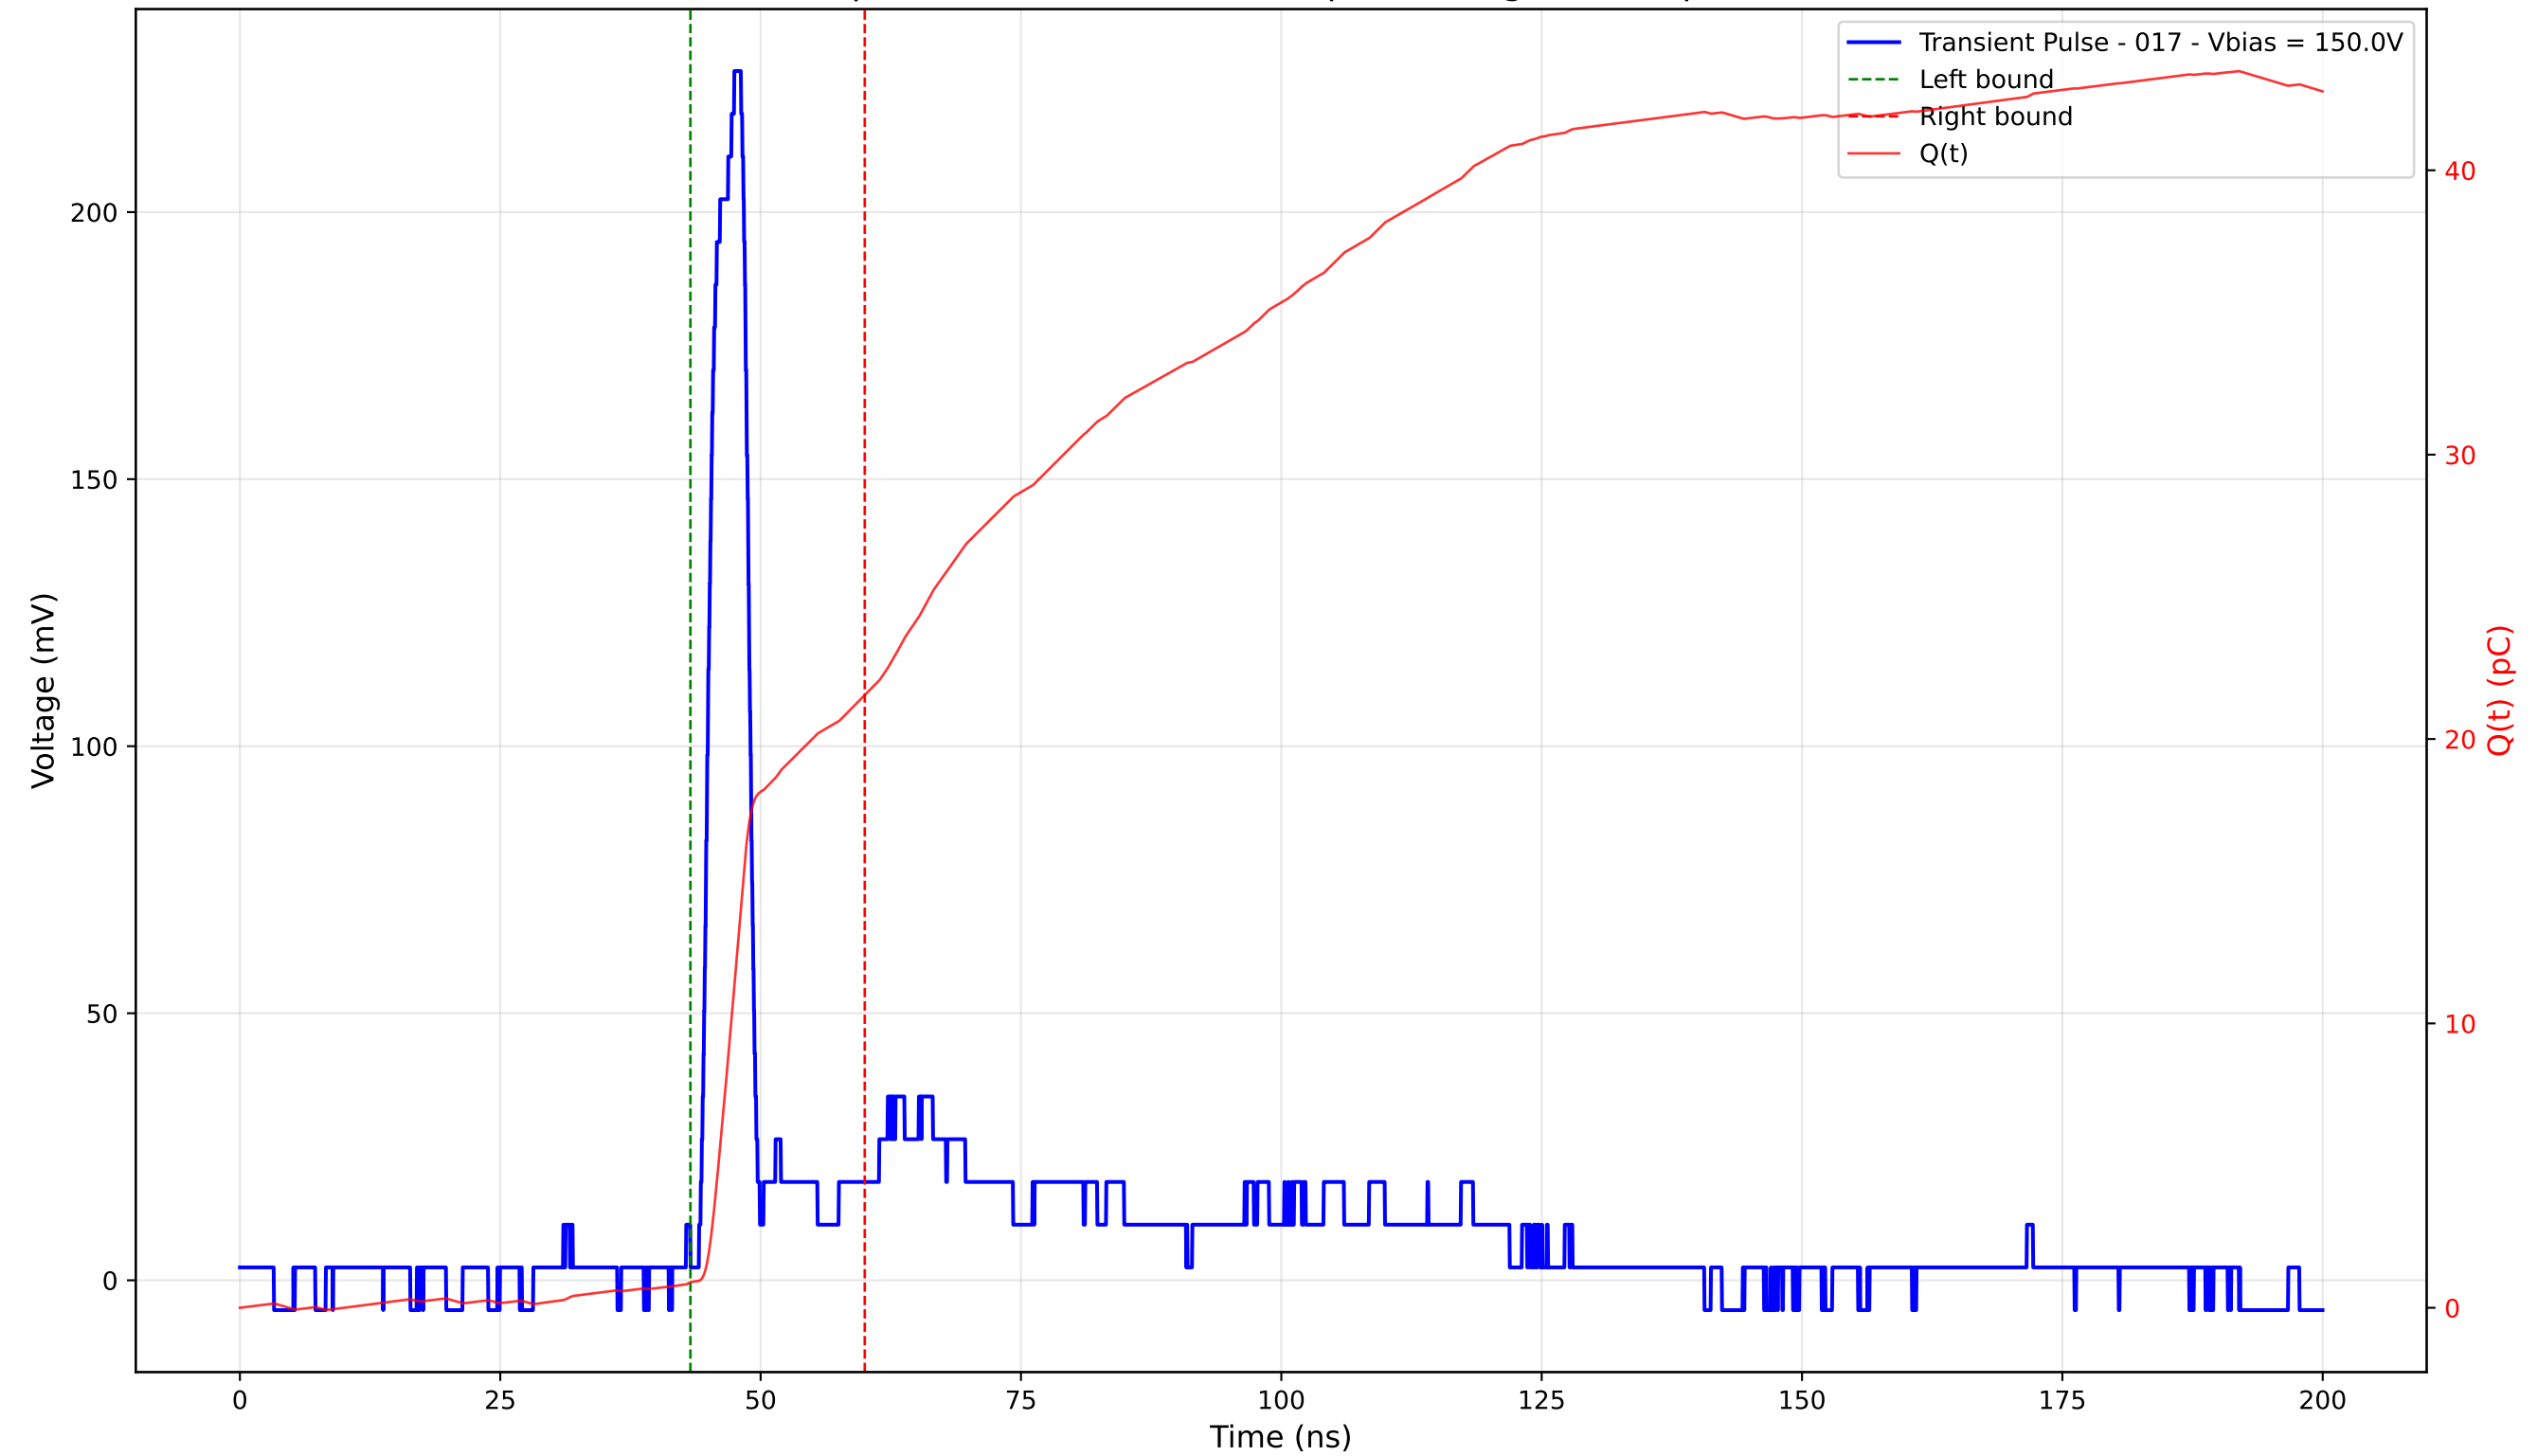


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 19.26 pC - Rise Time: 2.97 ns

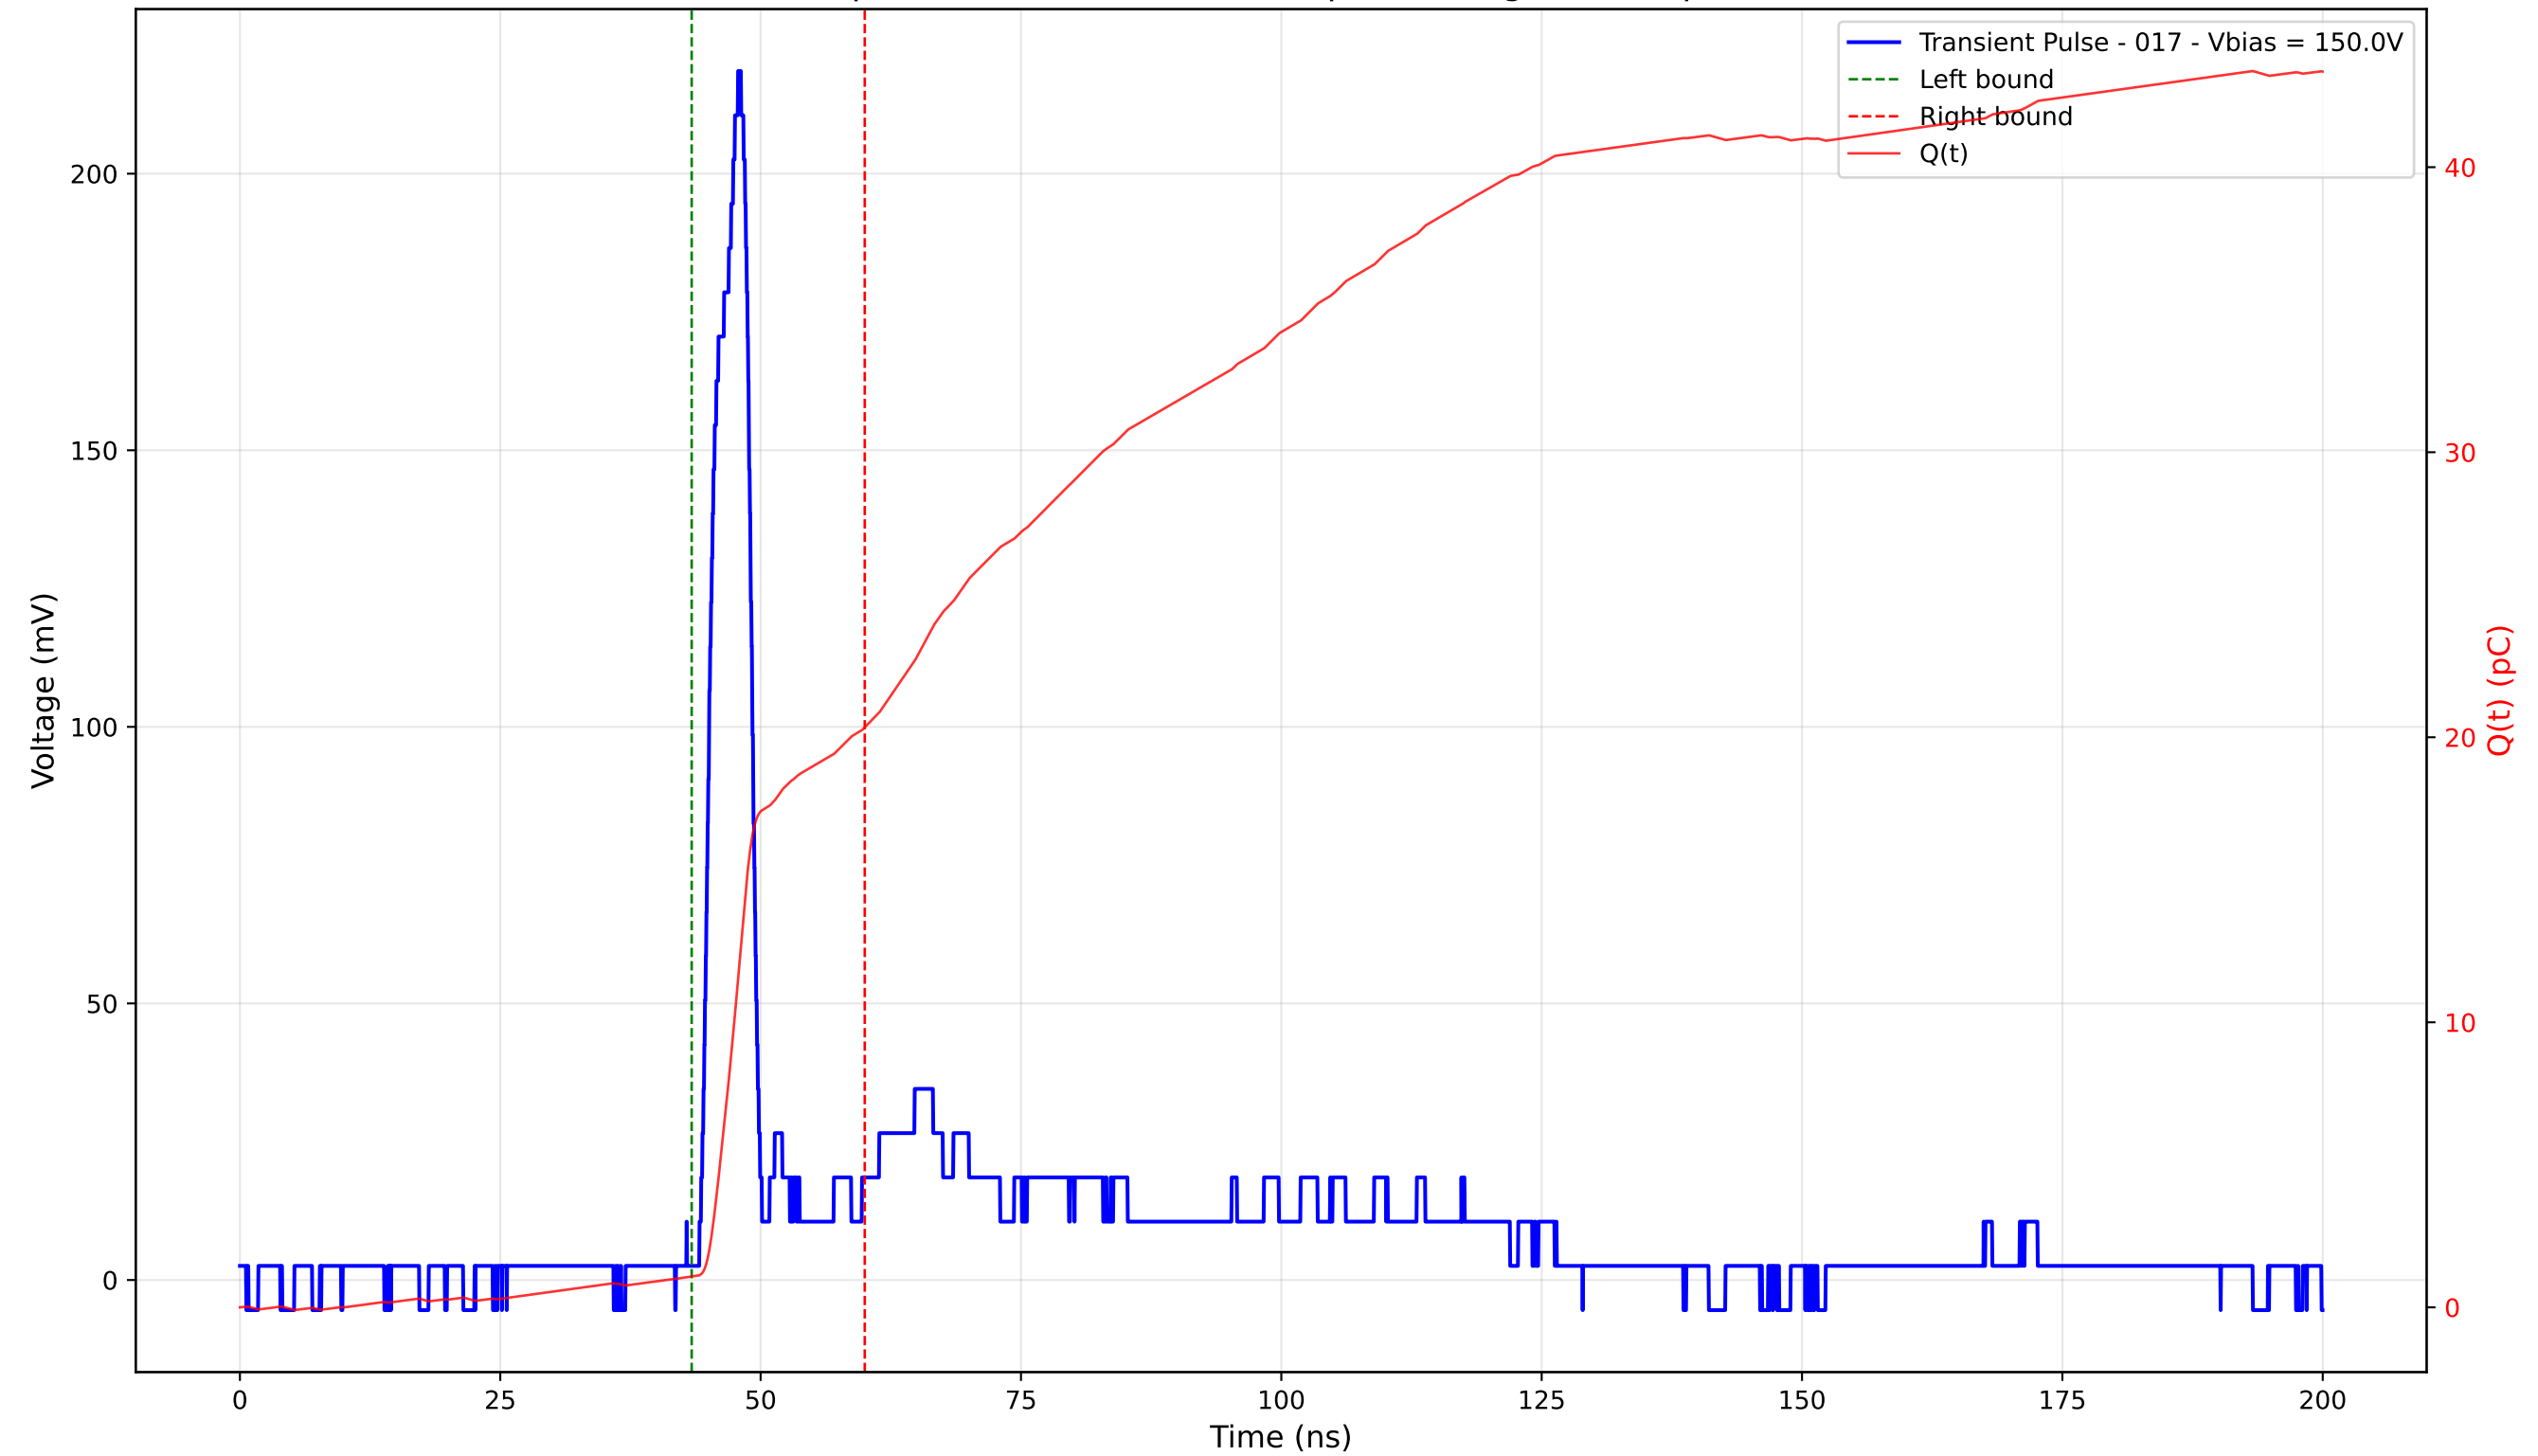


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 18.91 pC - Rise Time: 3.10 ns

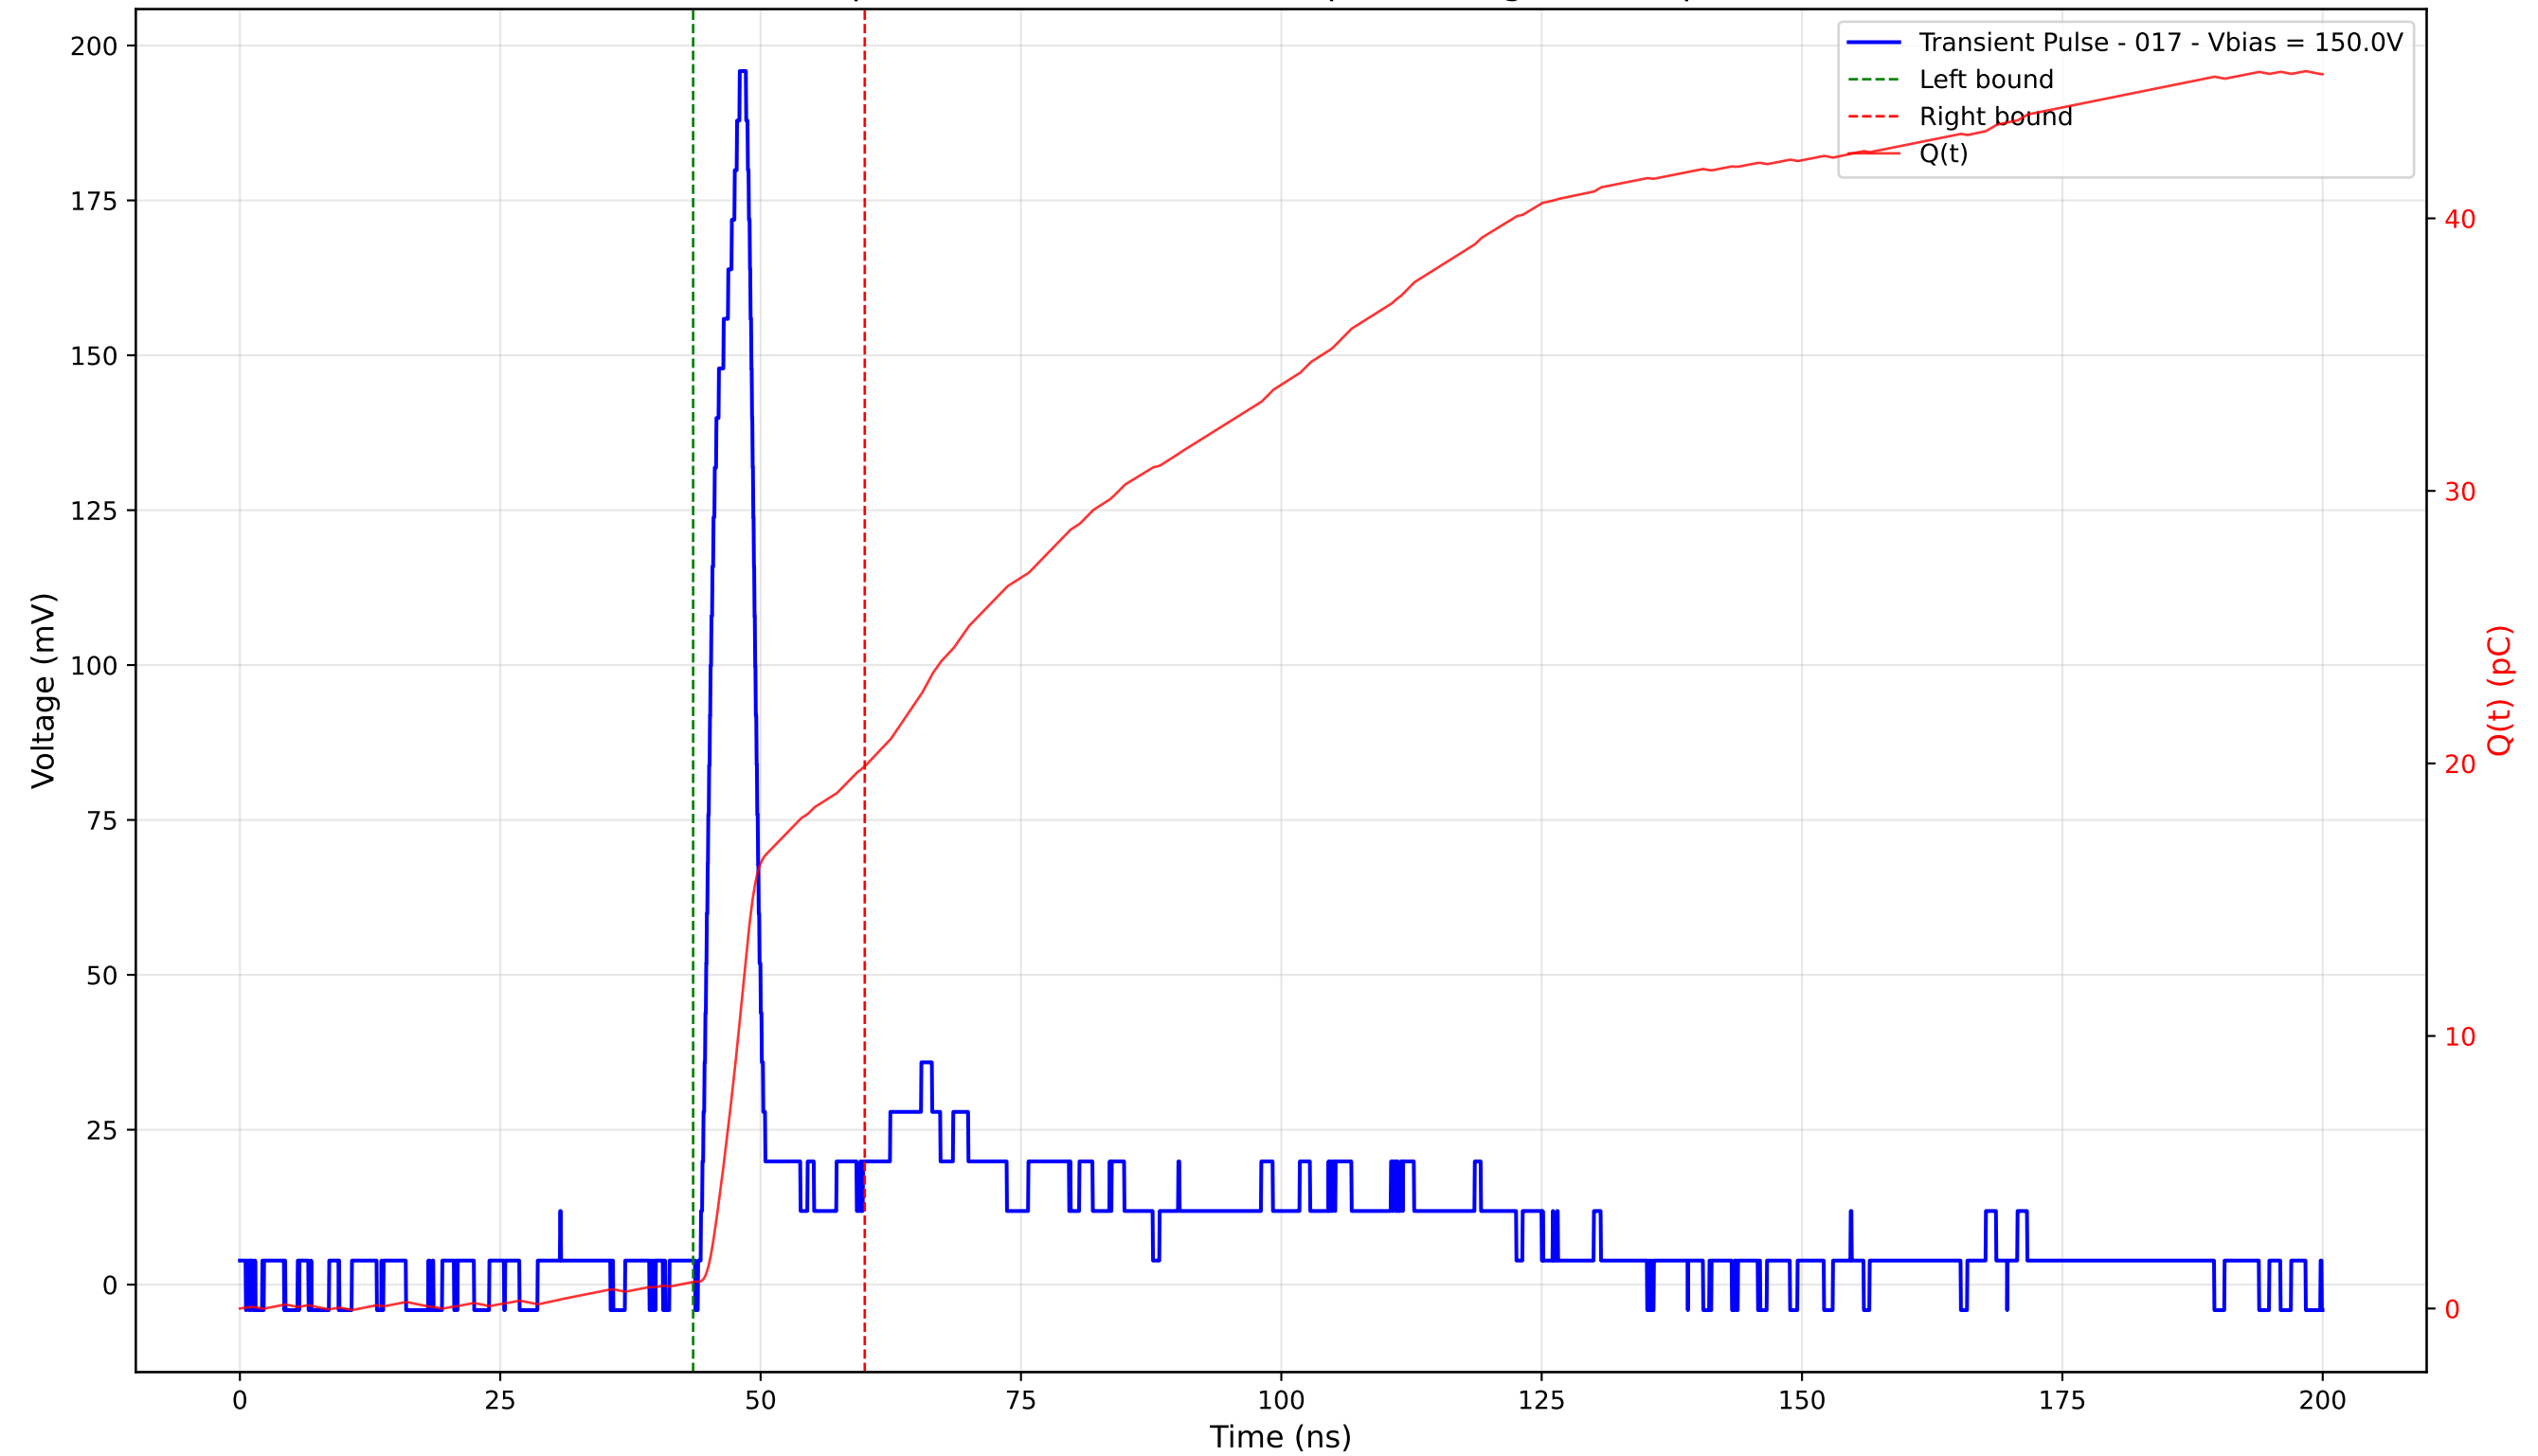


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 17.75 pC - Rise Time: 3.18 ns

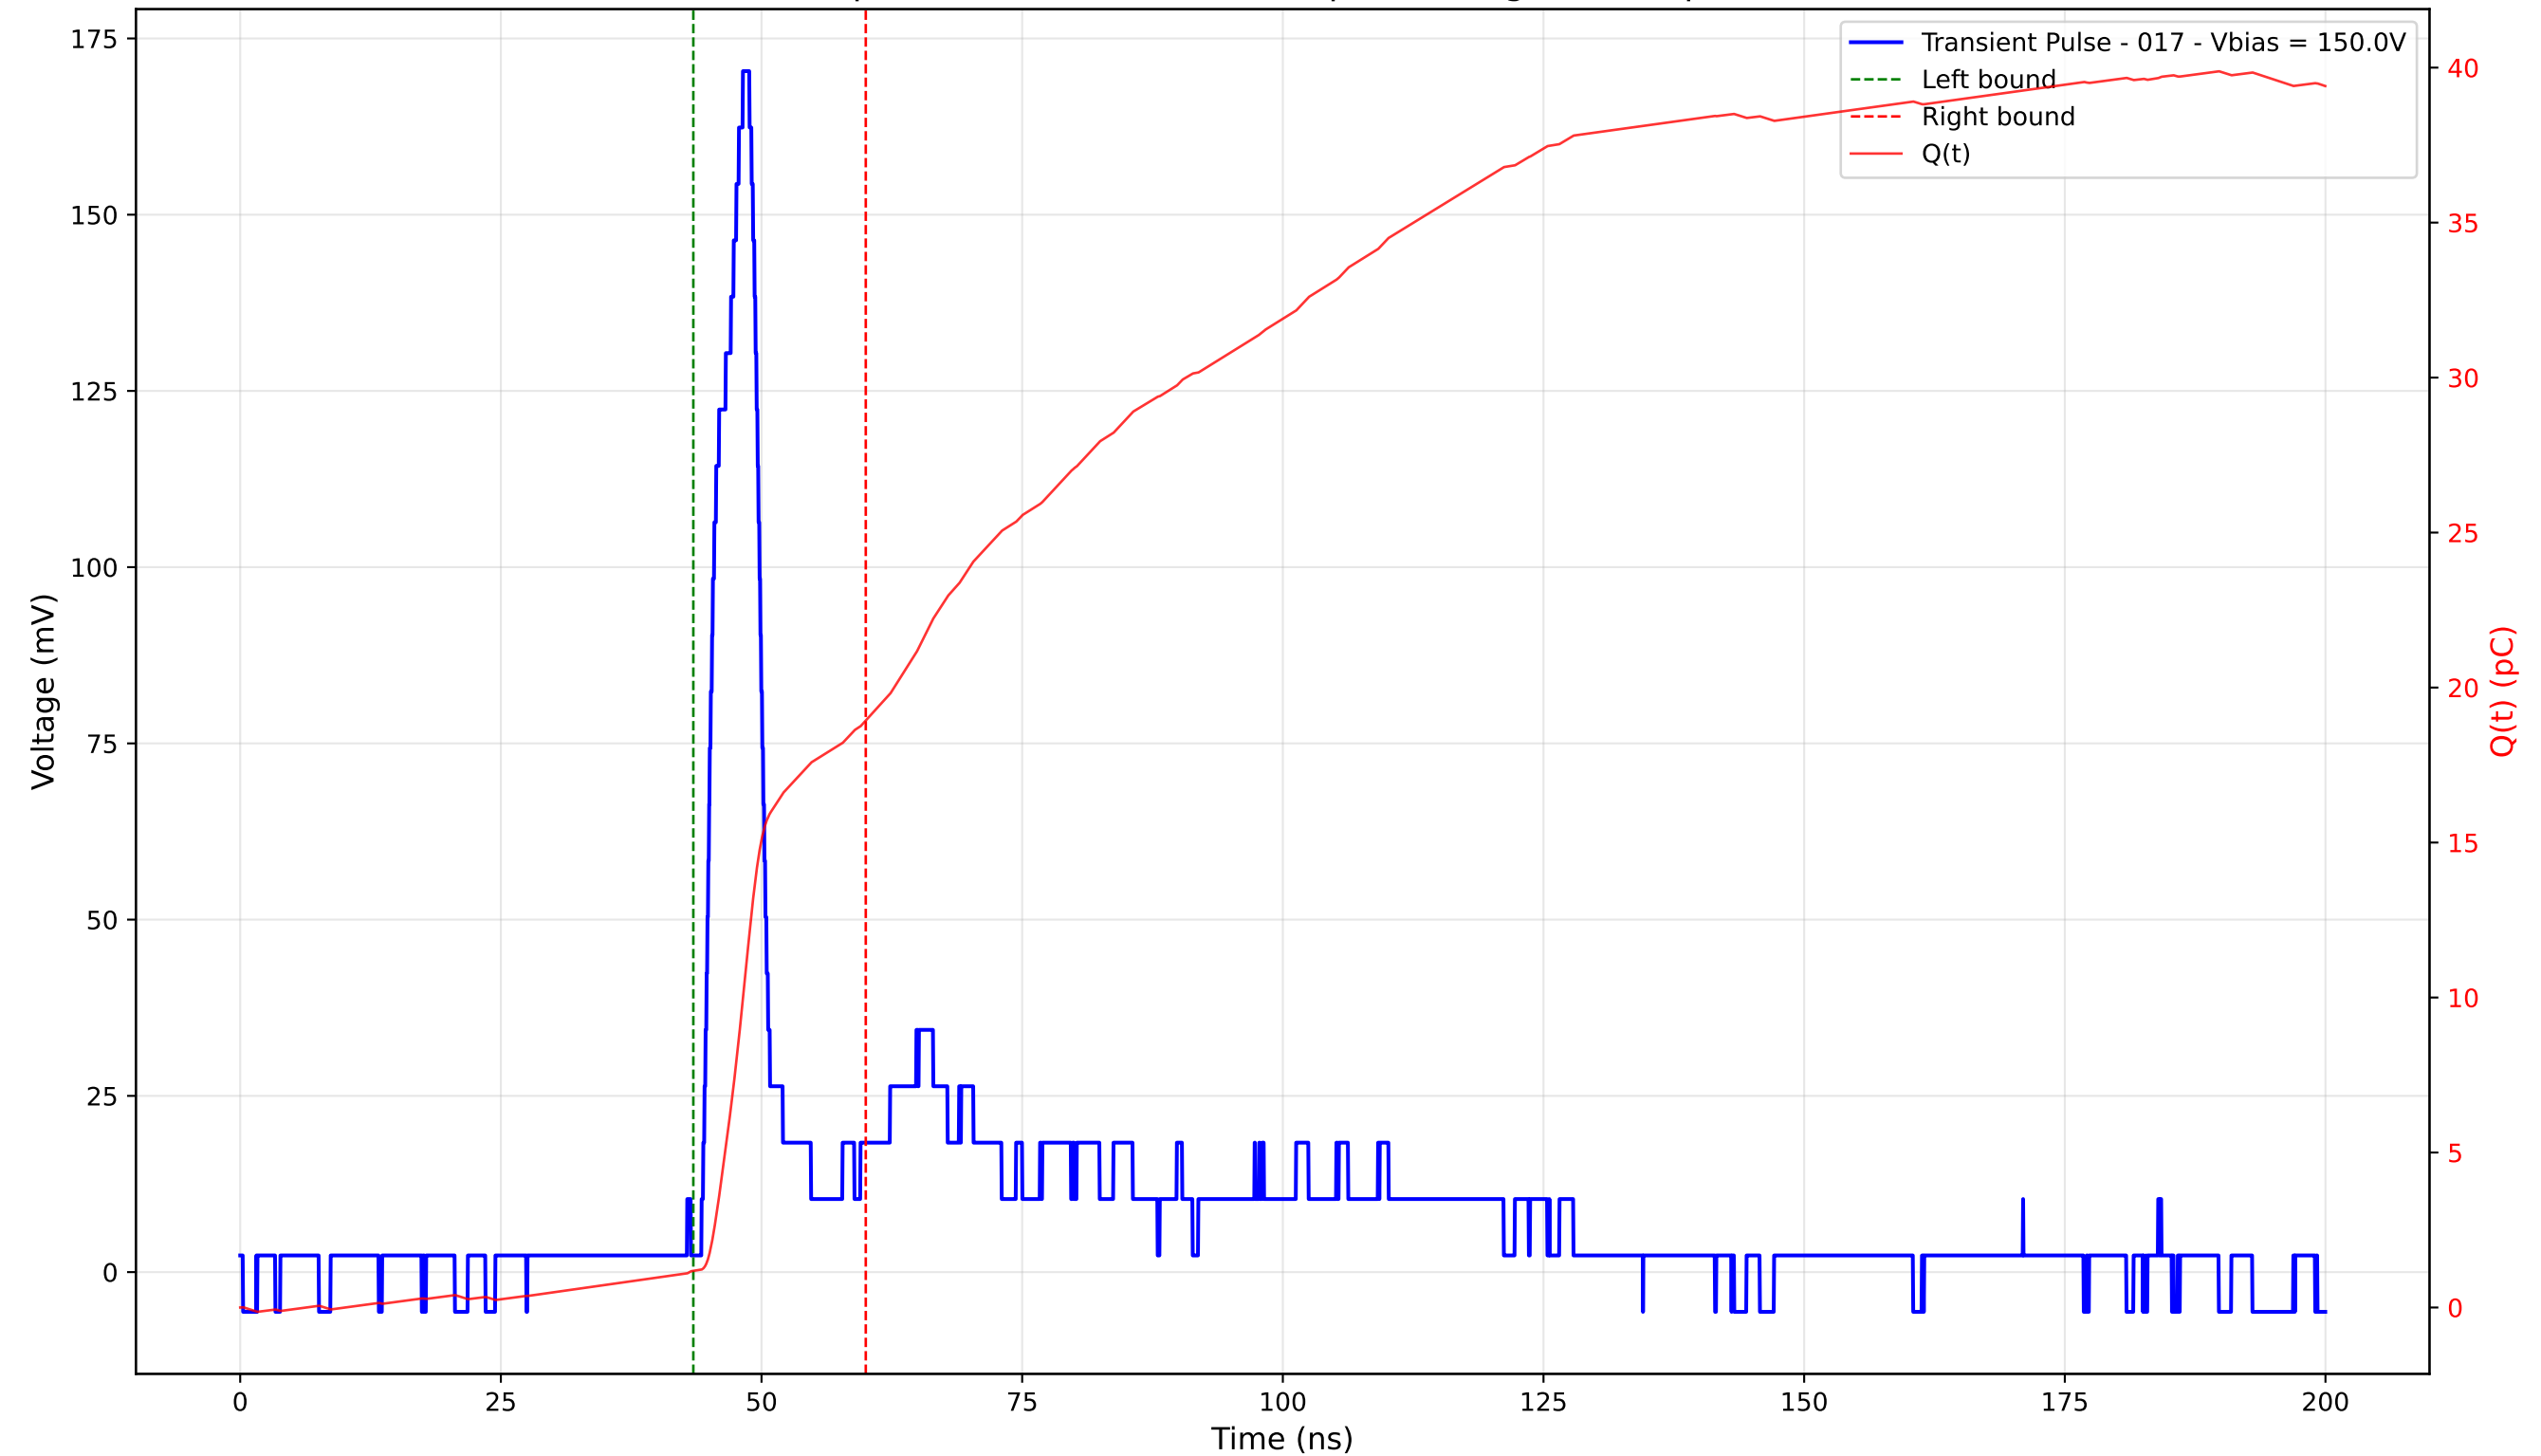


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 15.31 pC - Rise Time: 3.71 ns

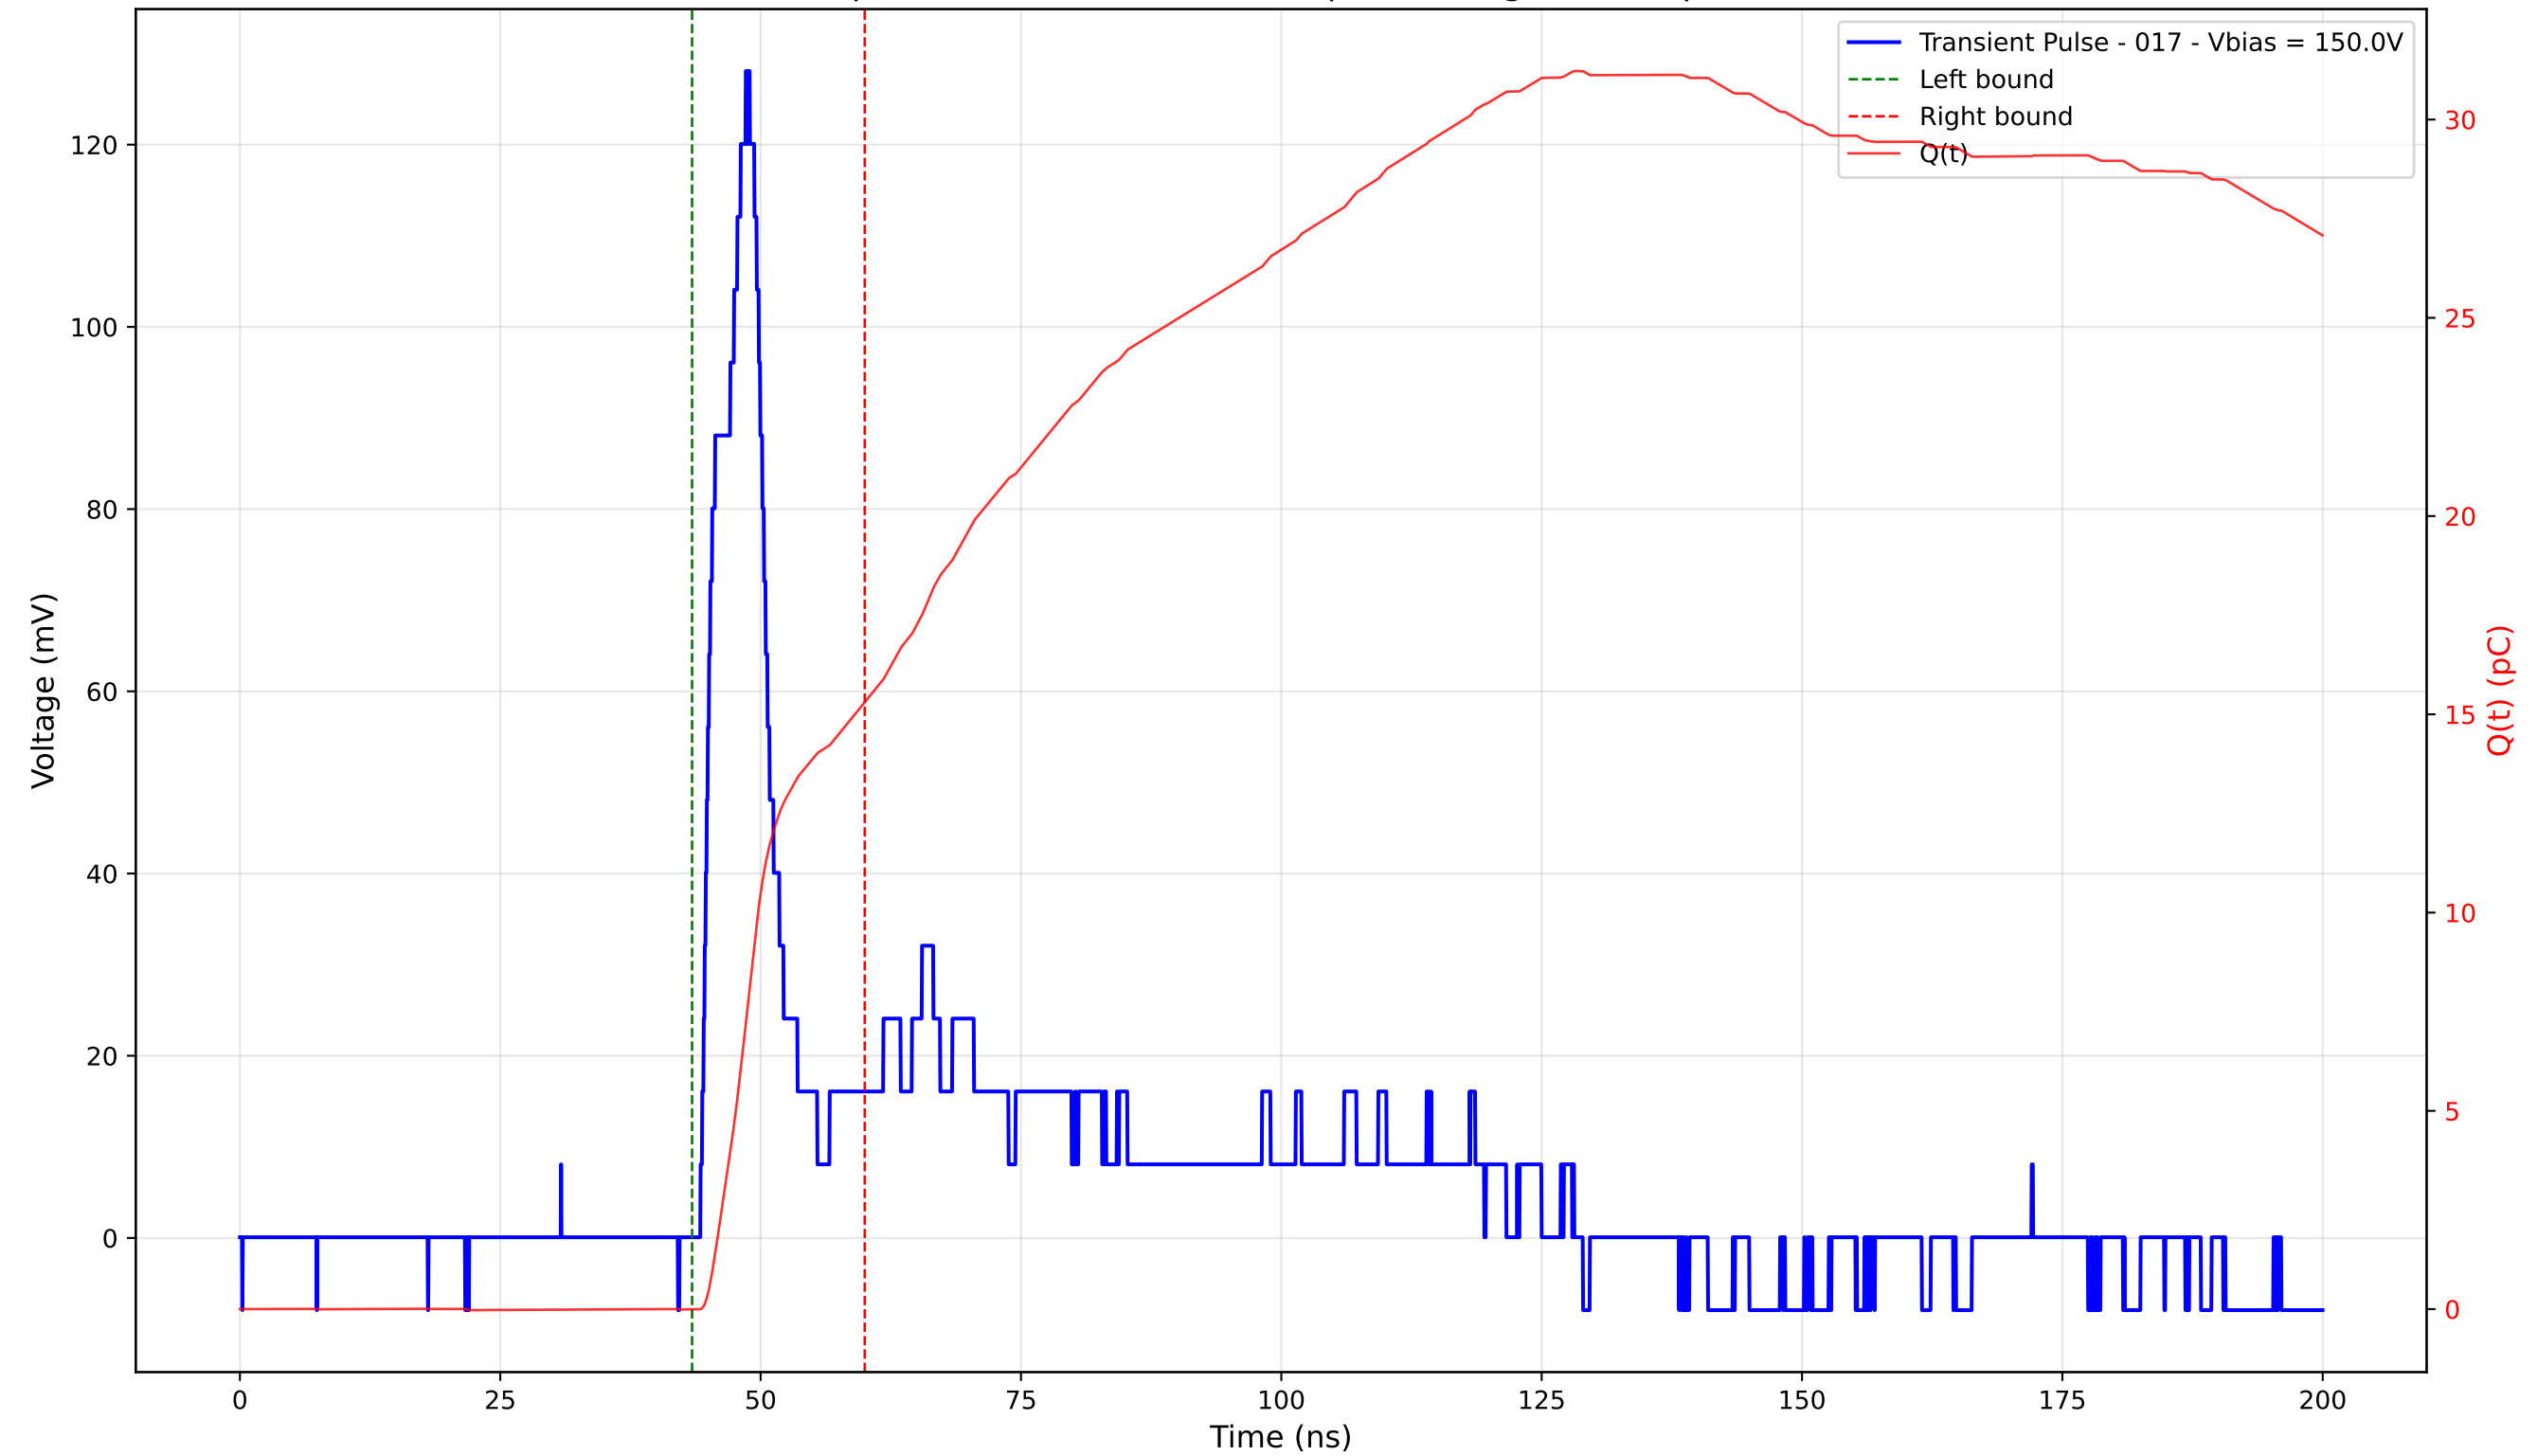


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 13.84 pC - Rise Time: 3.53 ns

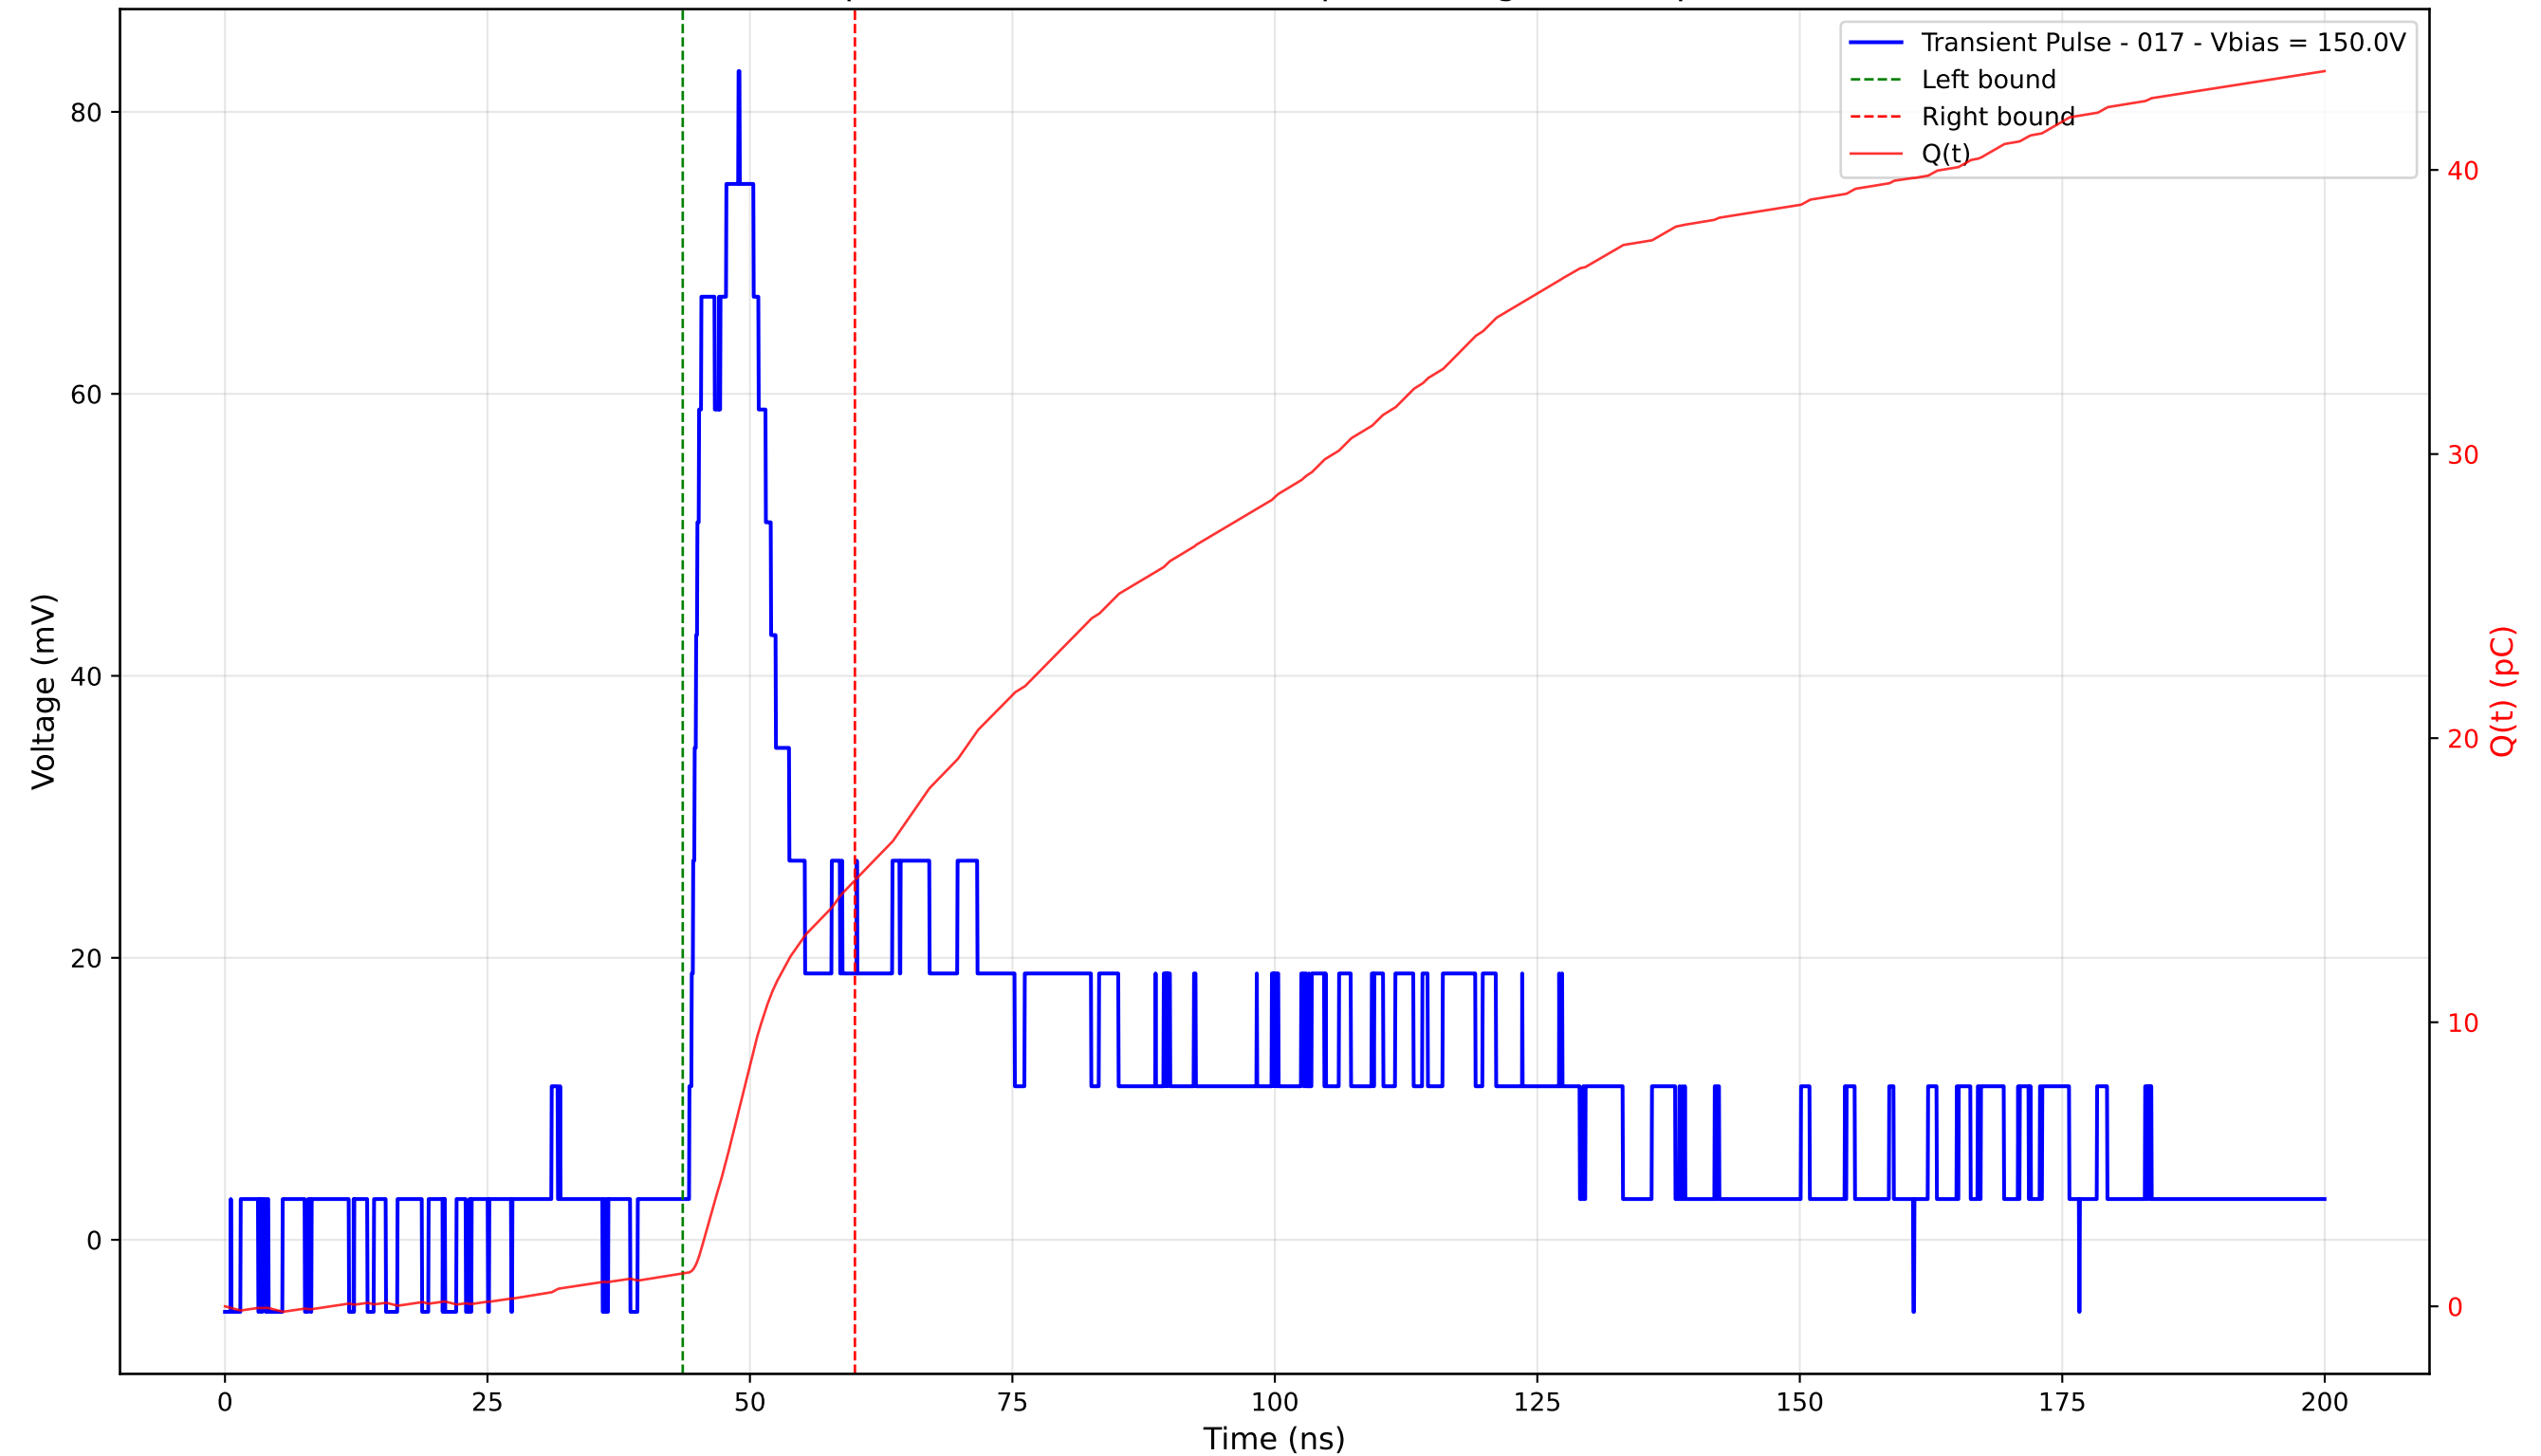


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 10.76 pC - Rise Time: 1.21 ns

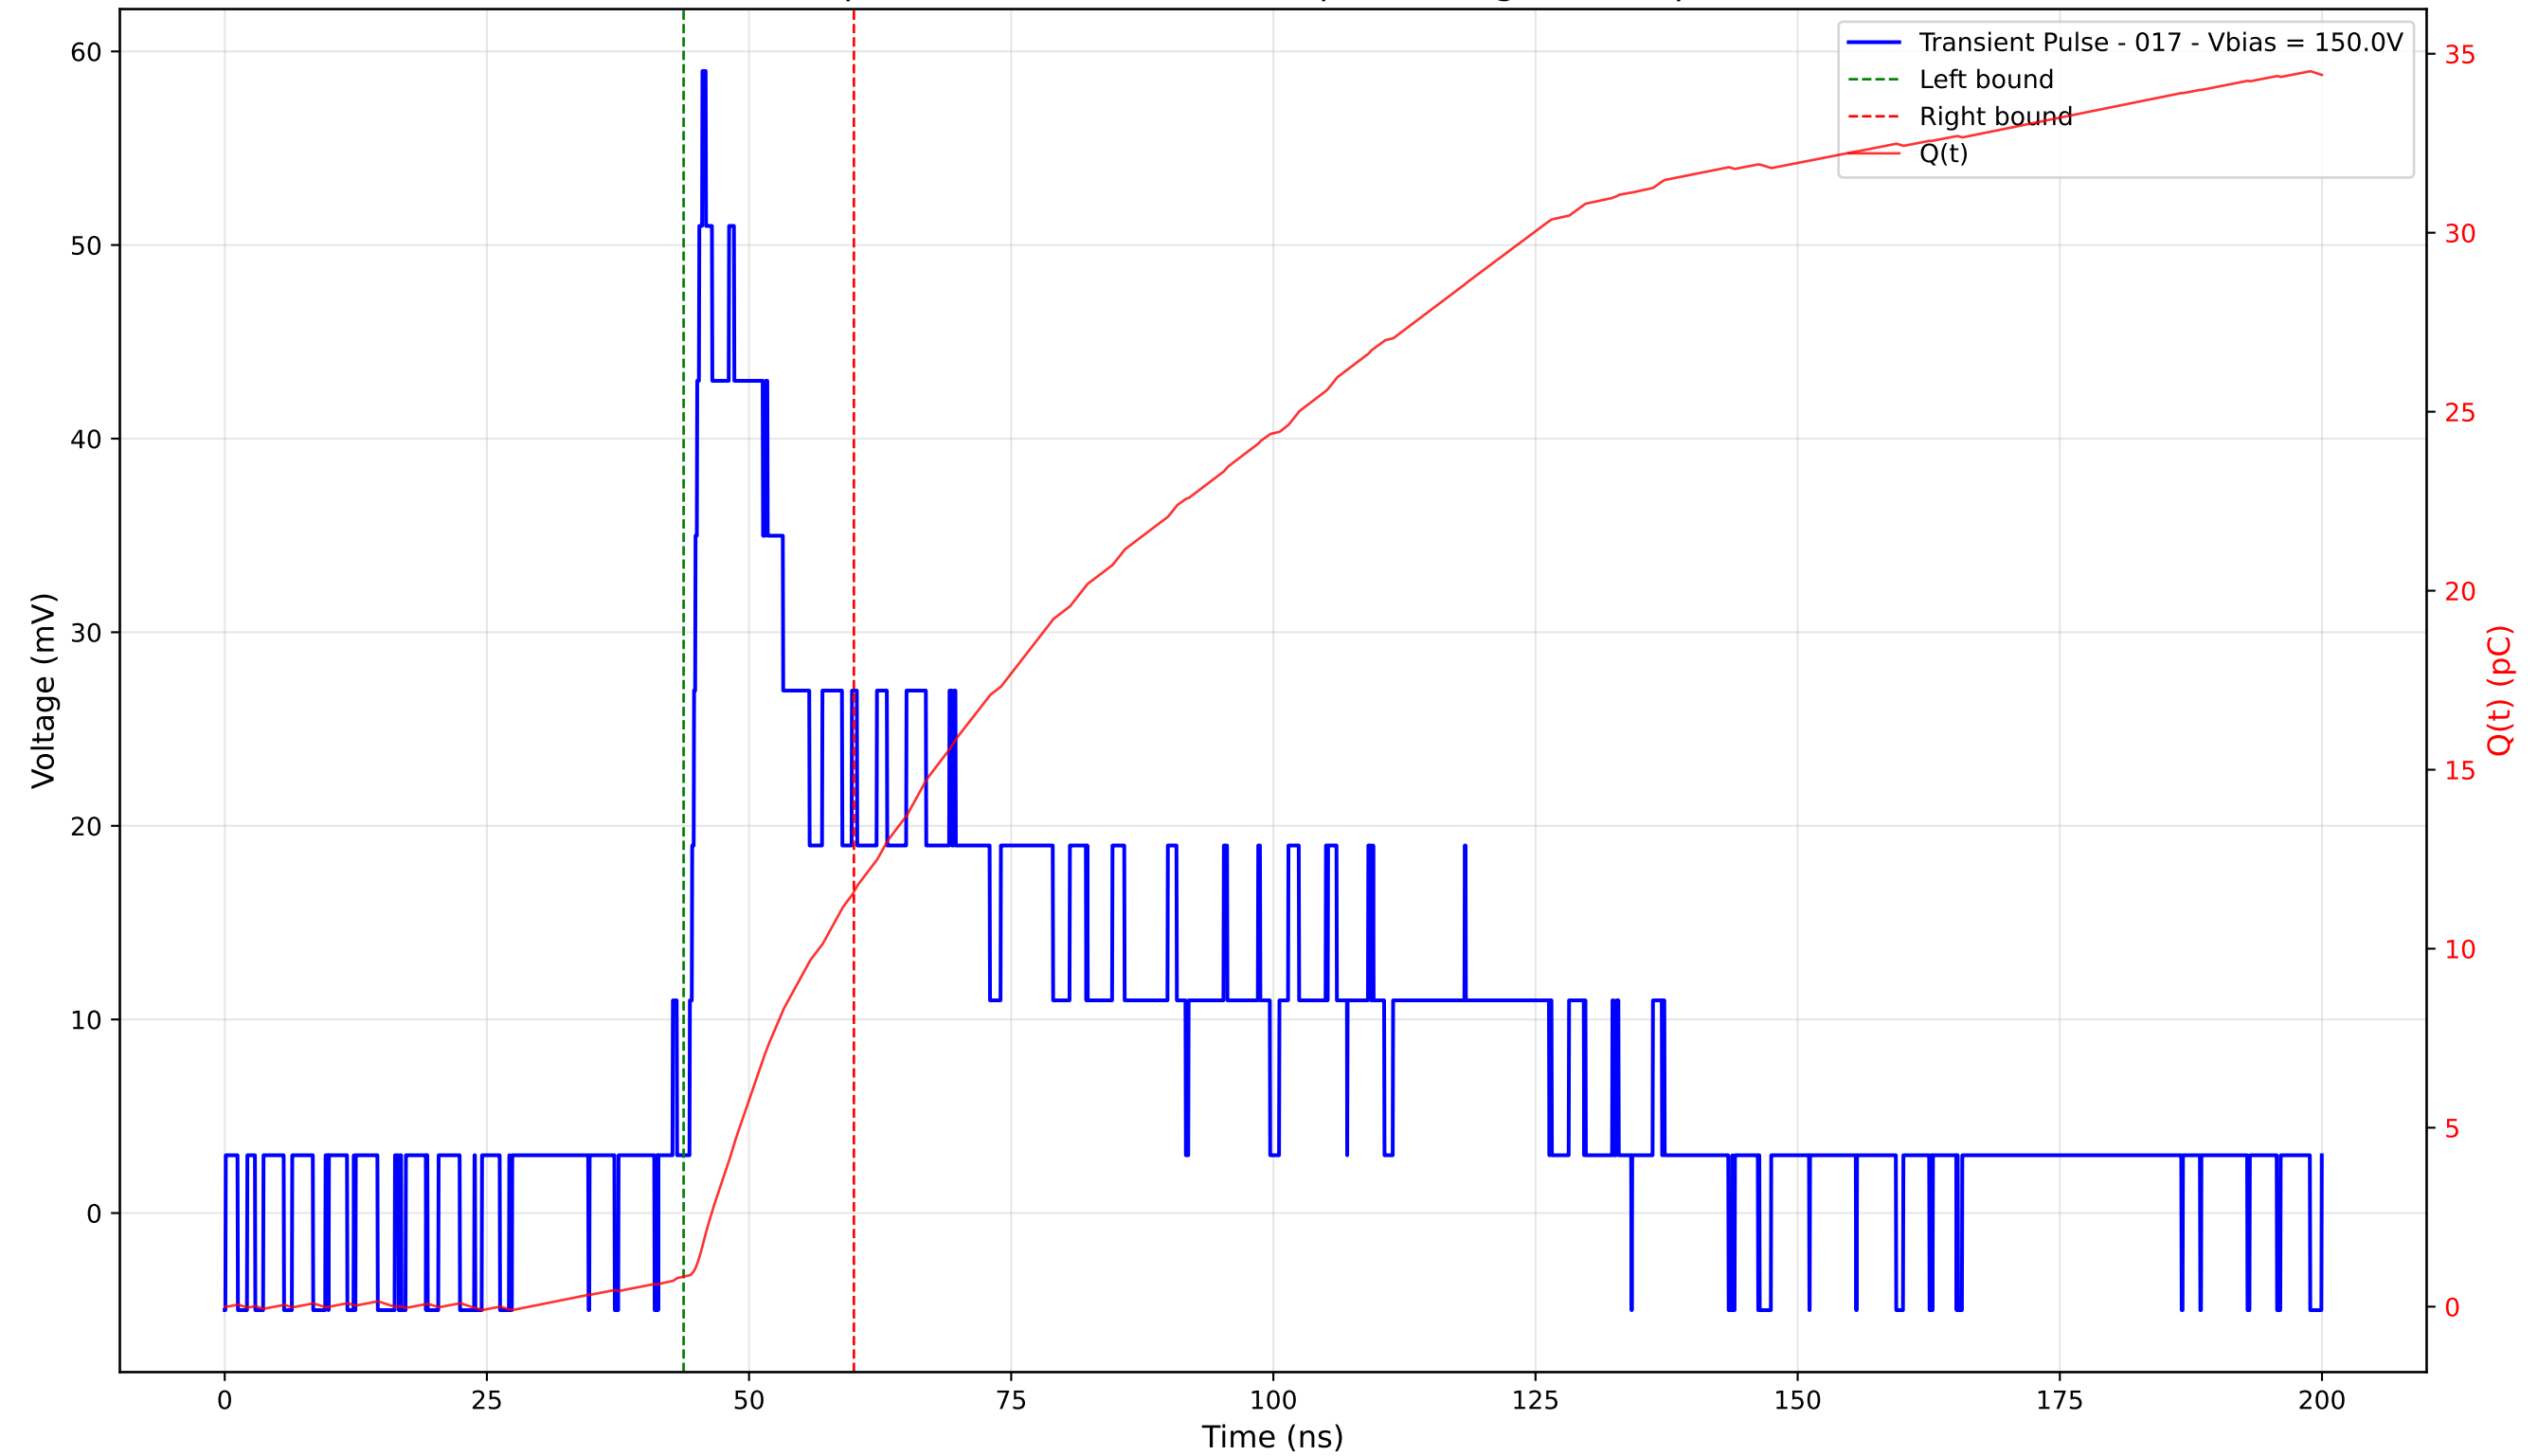


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 7.04 pC - Rise Time: 1.17 ns

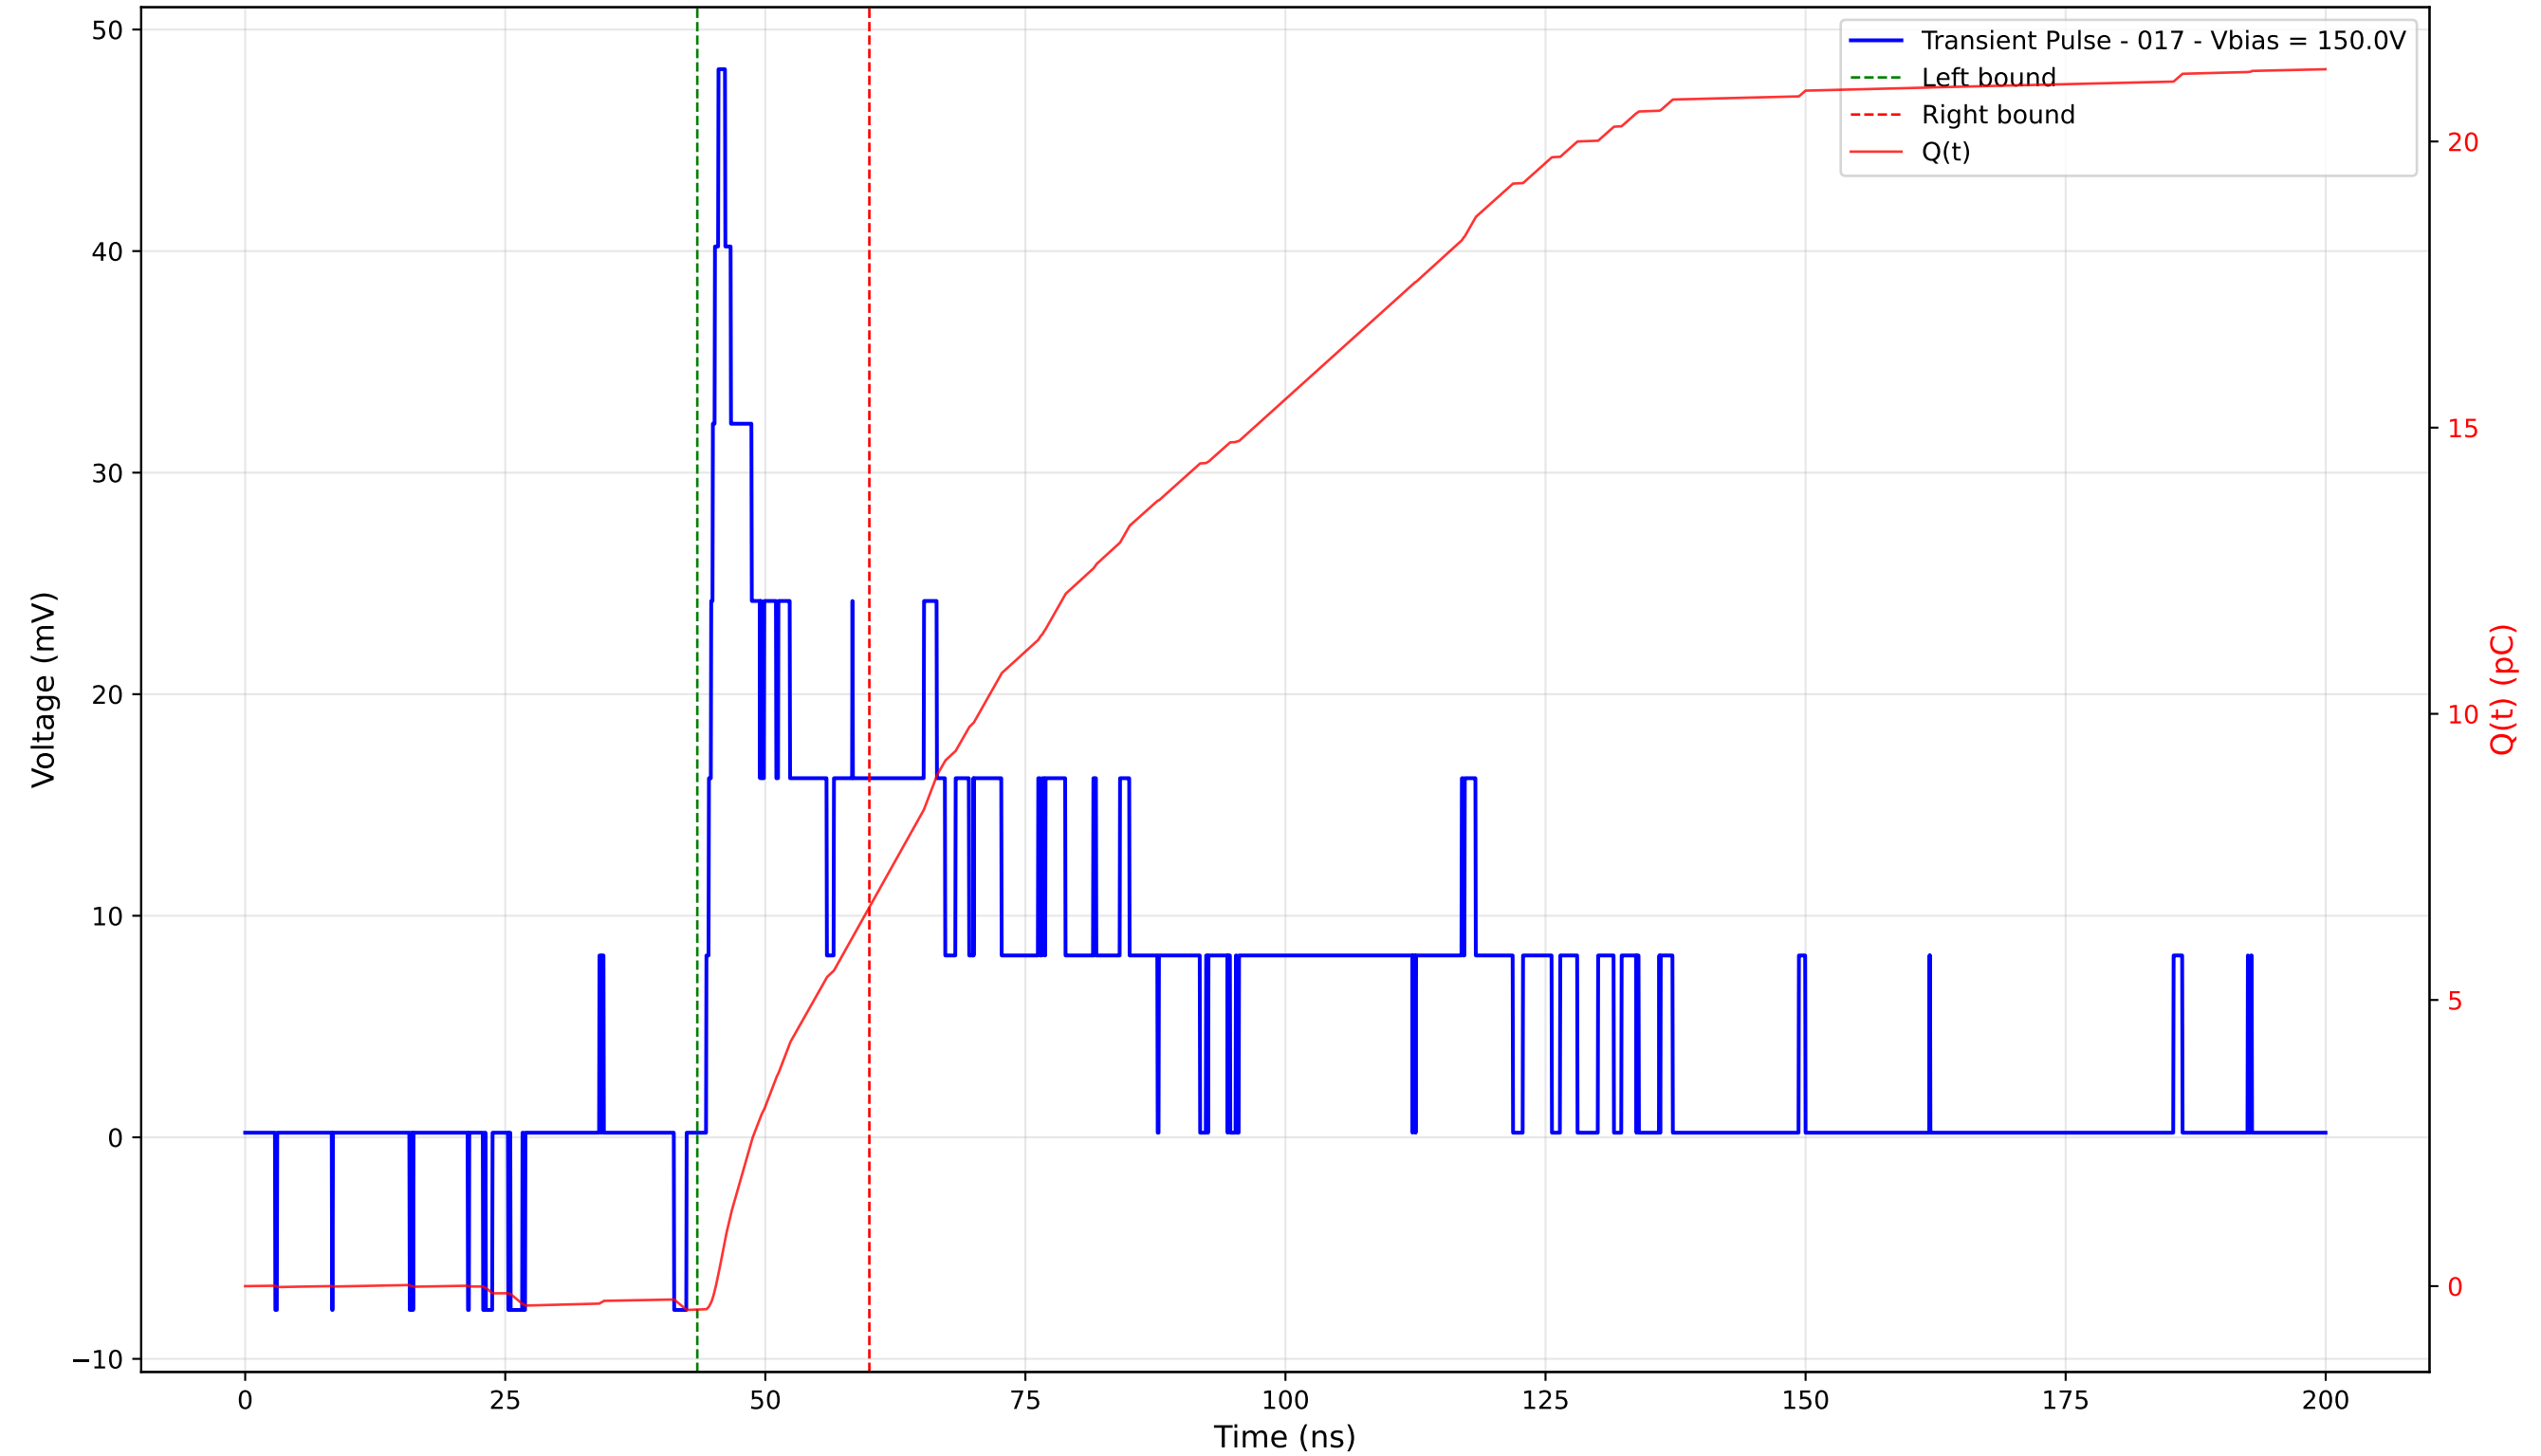


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 6.29 pC - Rise Time: 0.96 ns

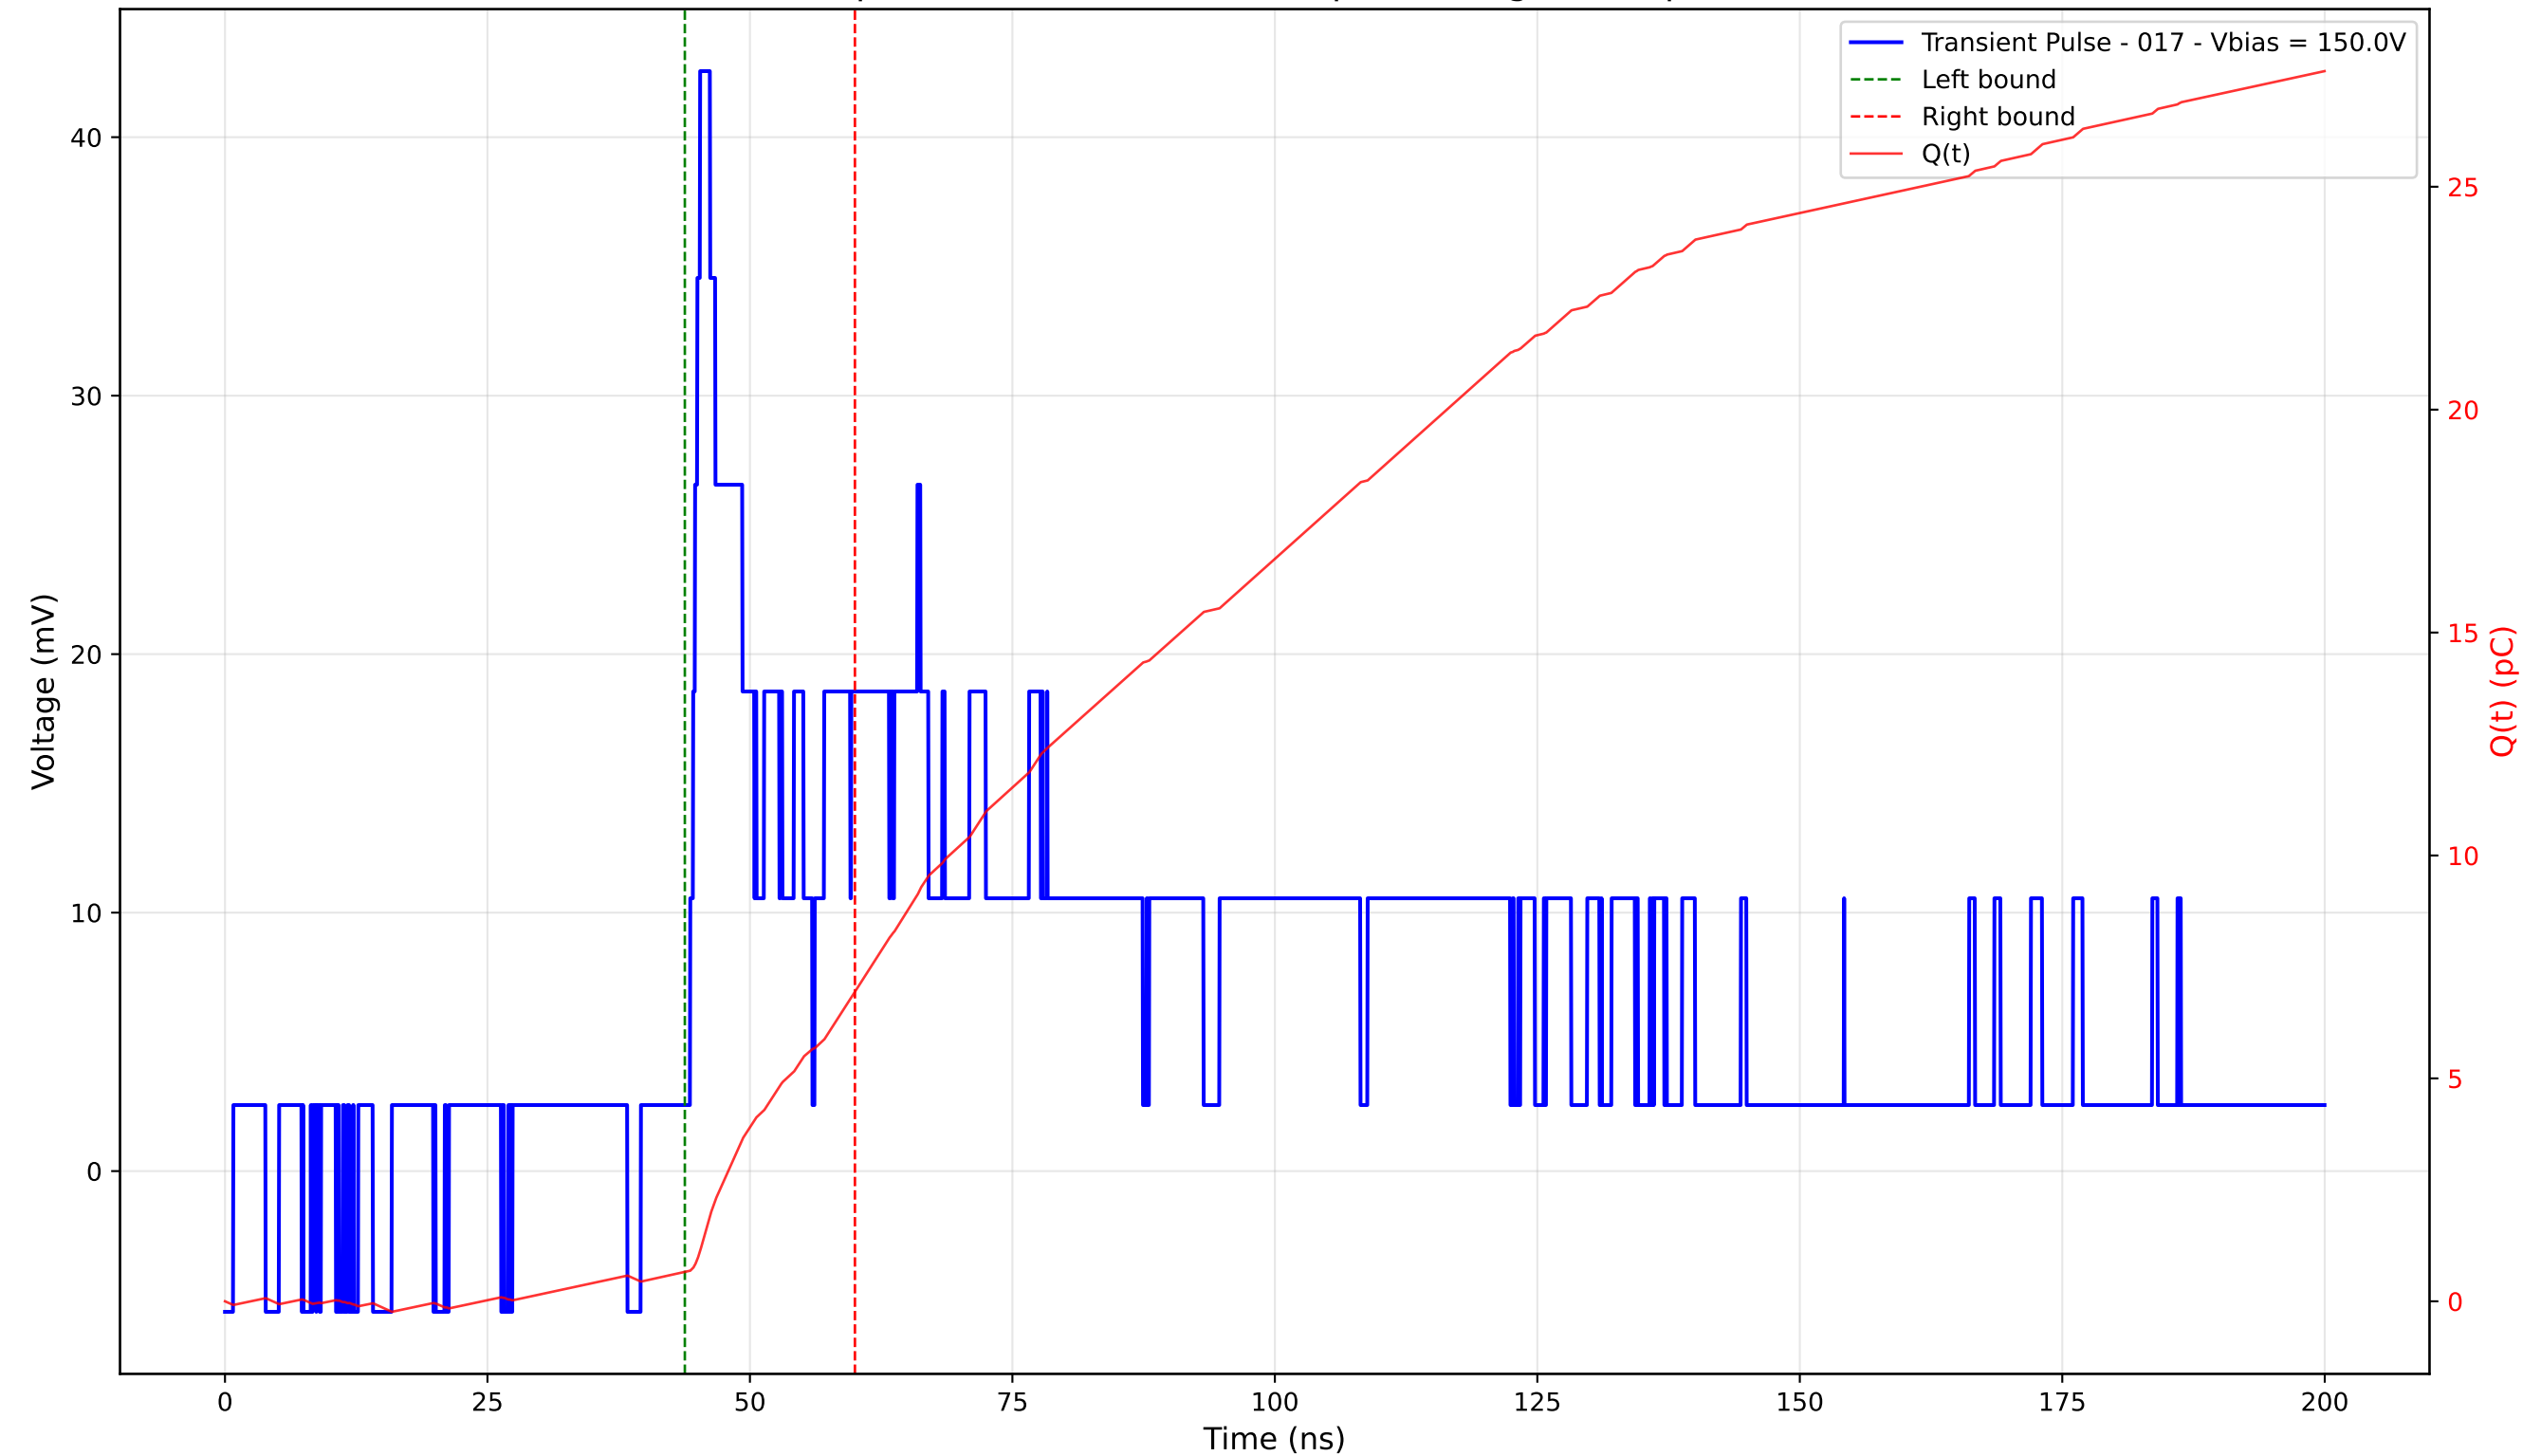


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 4.94 pC - Rise Time: 0.00 ns (N/A)

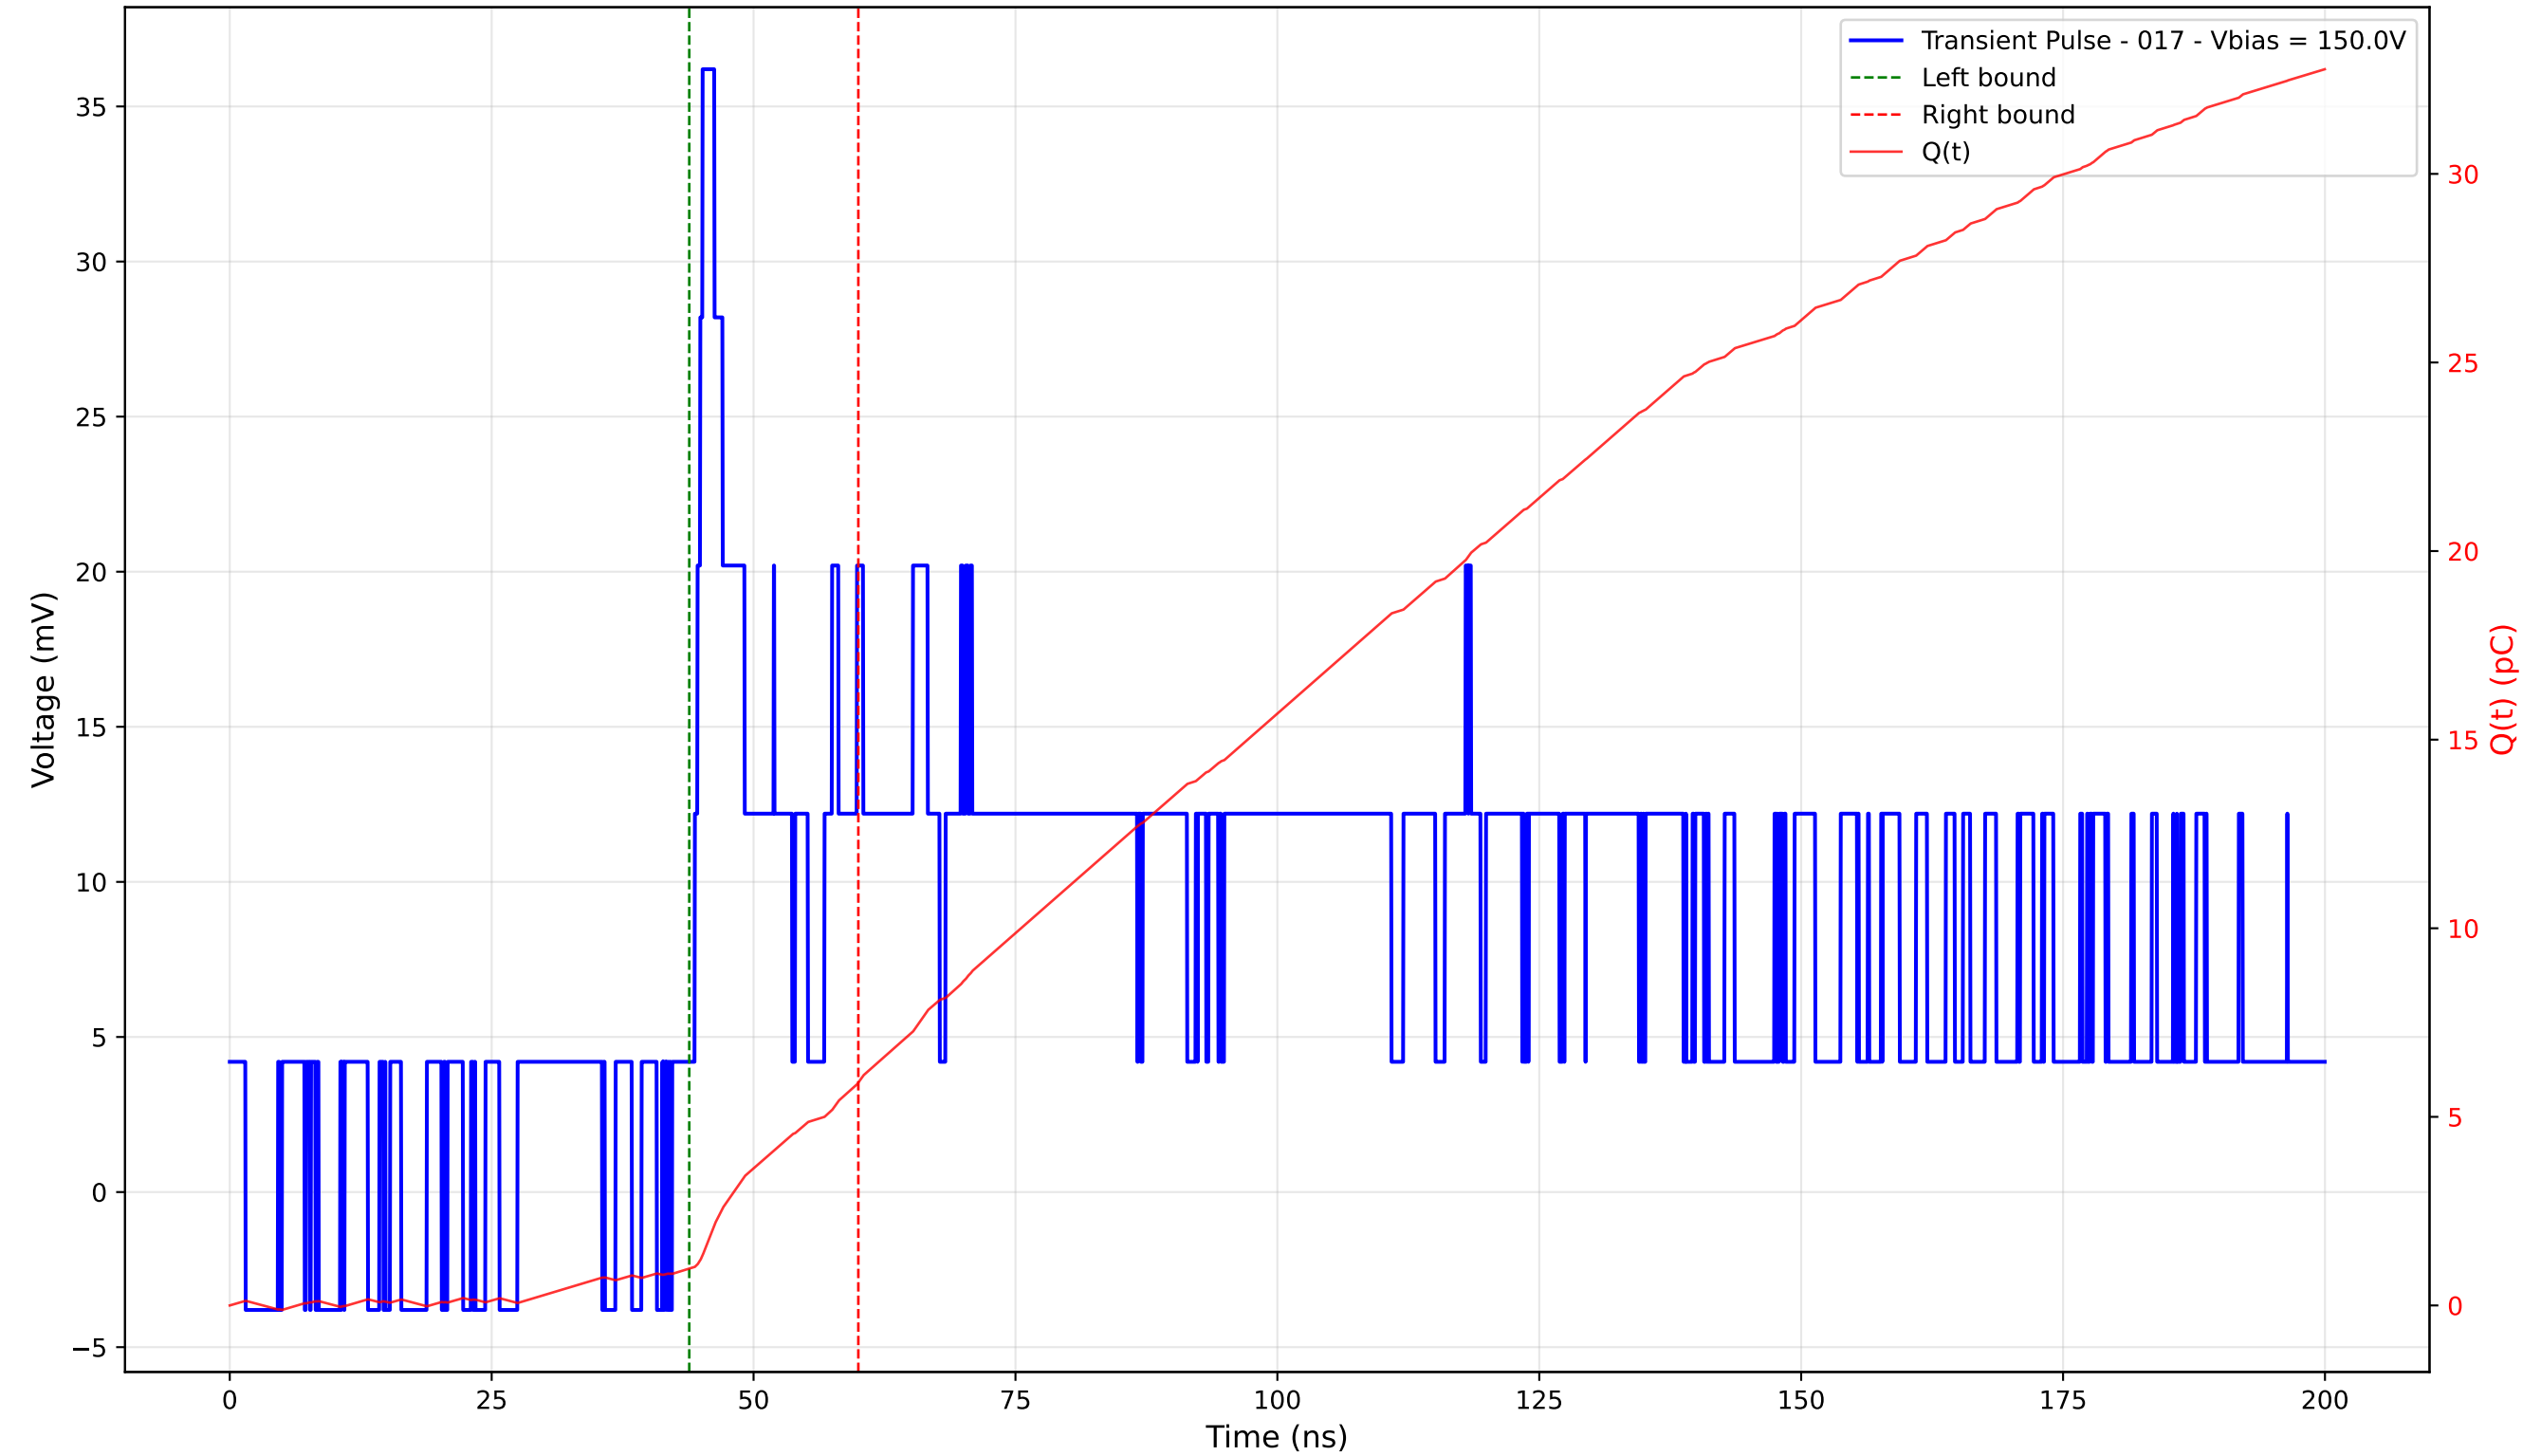


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 3.44 pC - Rise Time: 1.19 ns

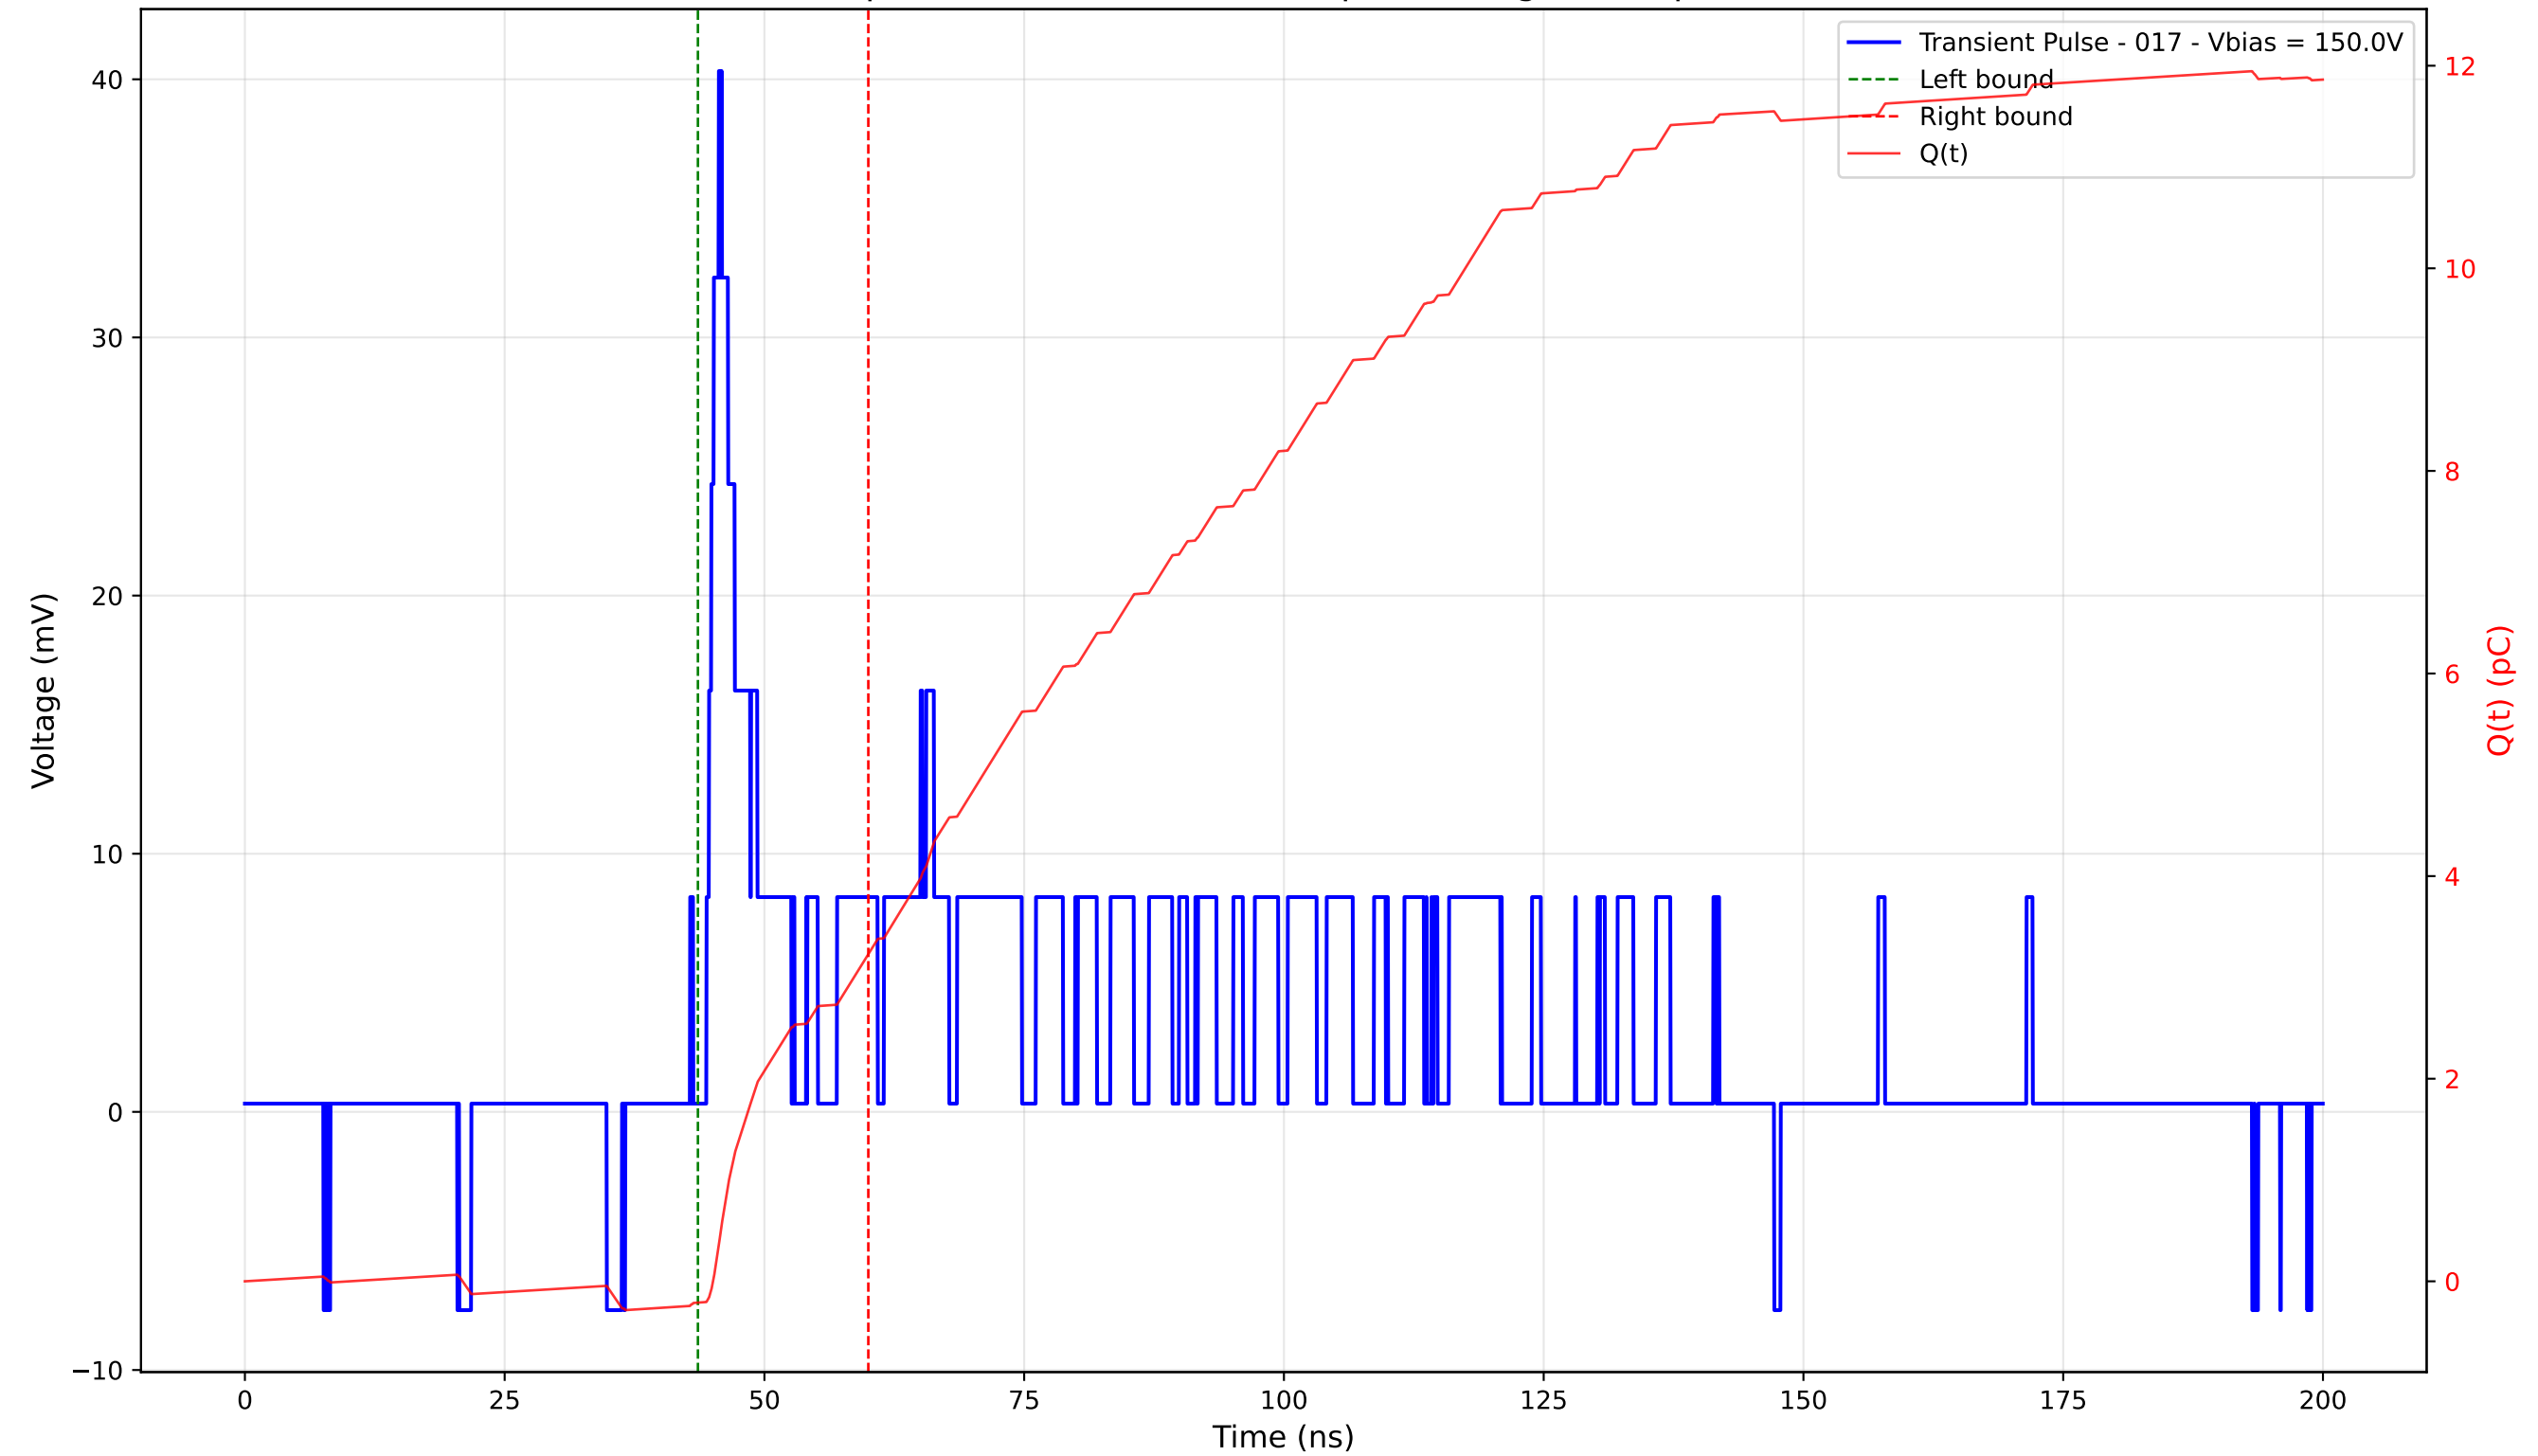


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 3.48 pC - Rise Time: 0.68 ns

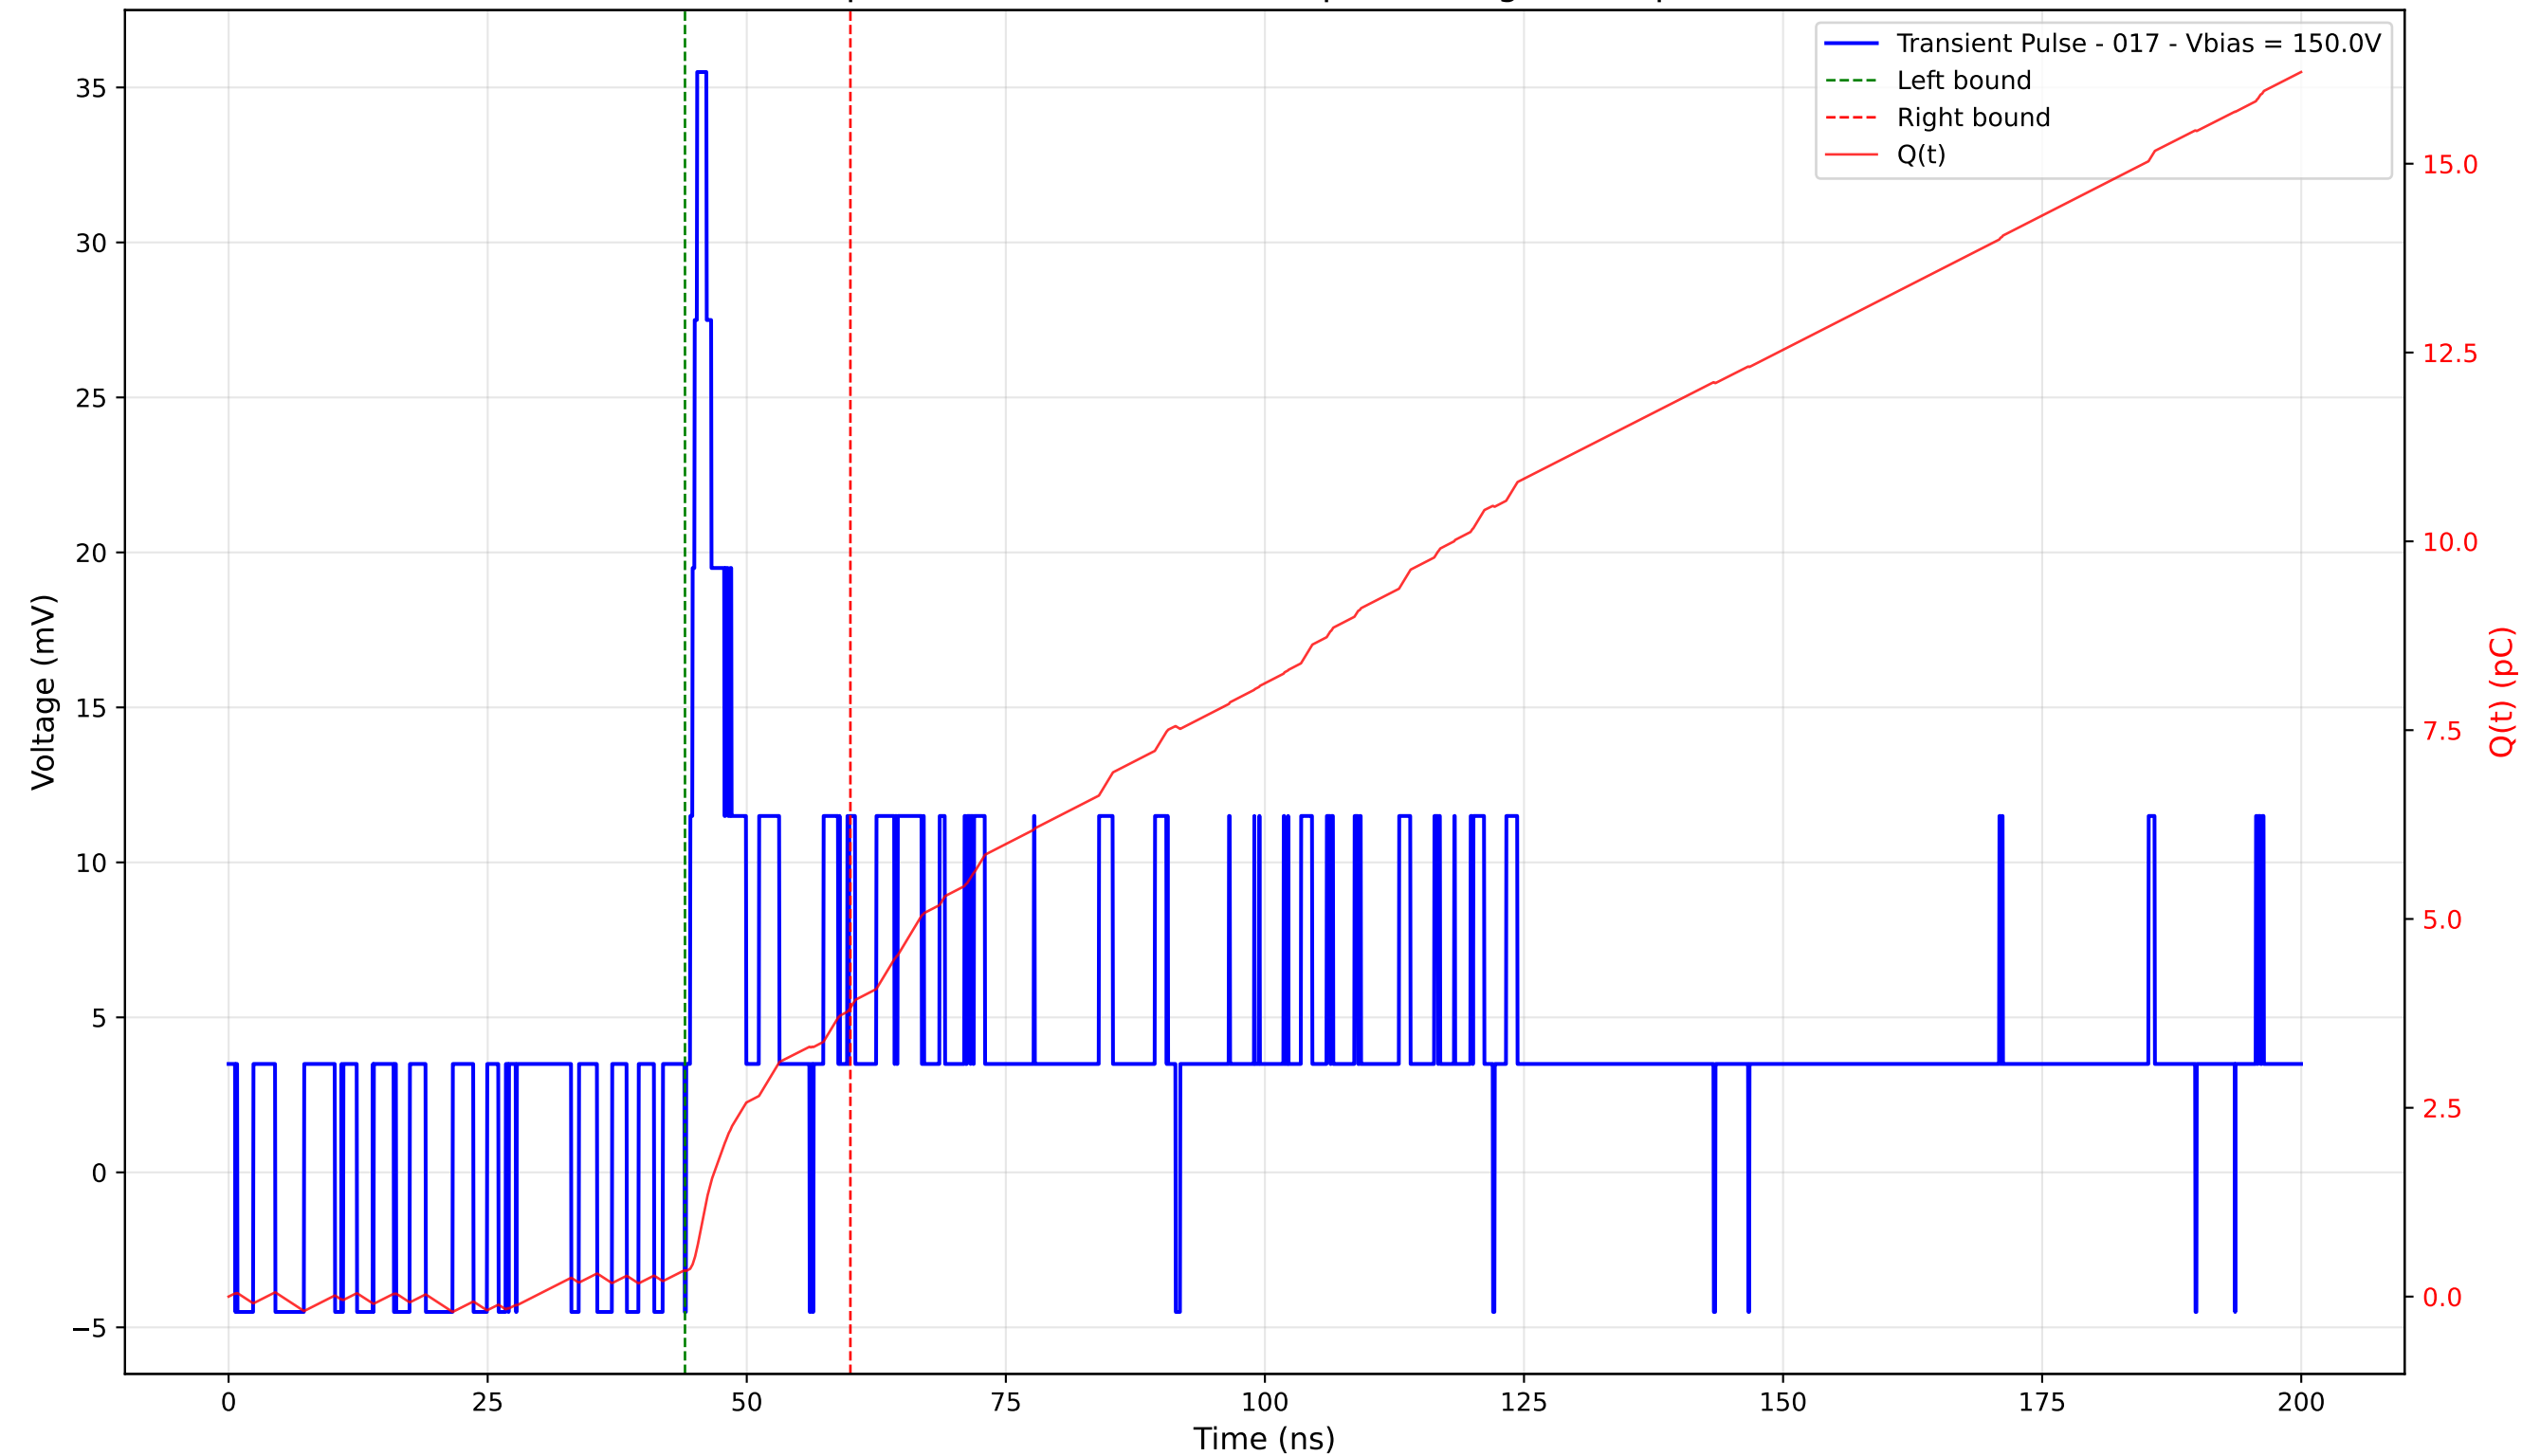


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 2.72 pC - Rise Time: 1.03 ns

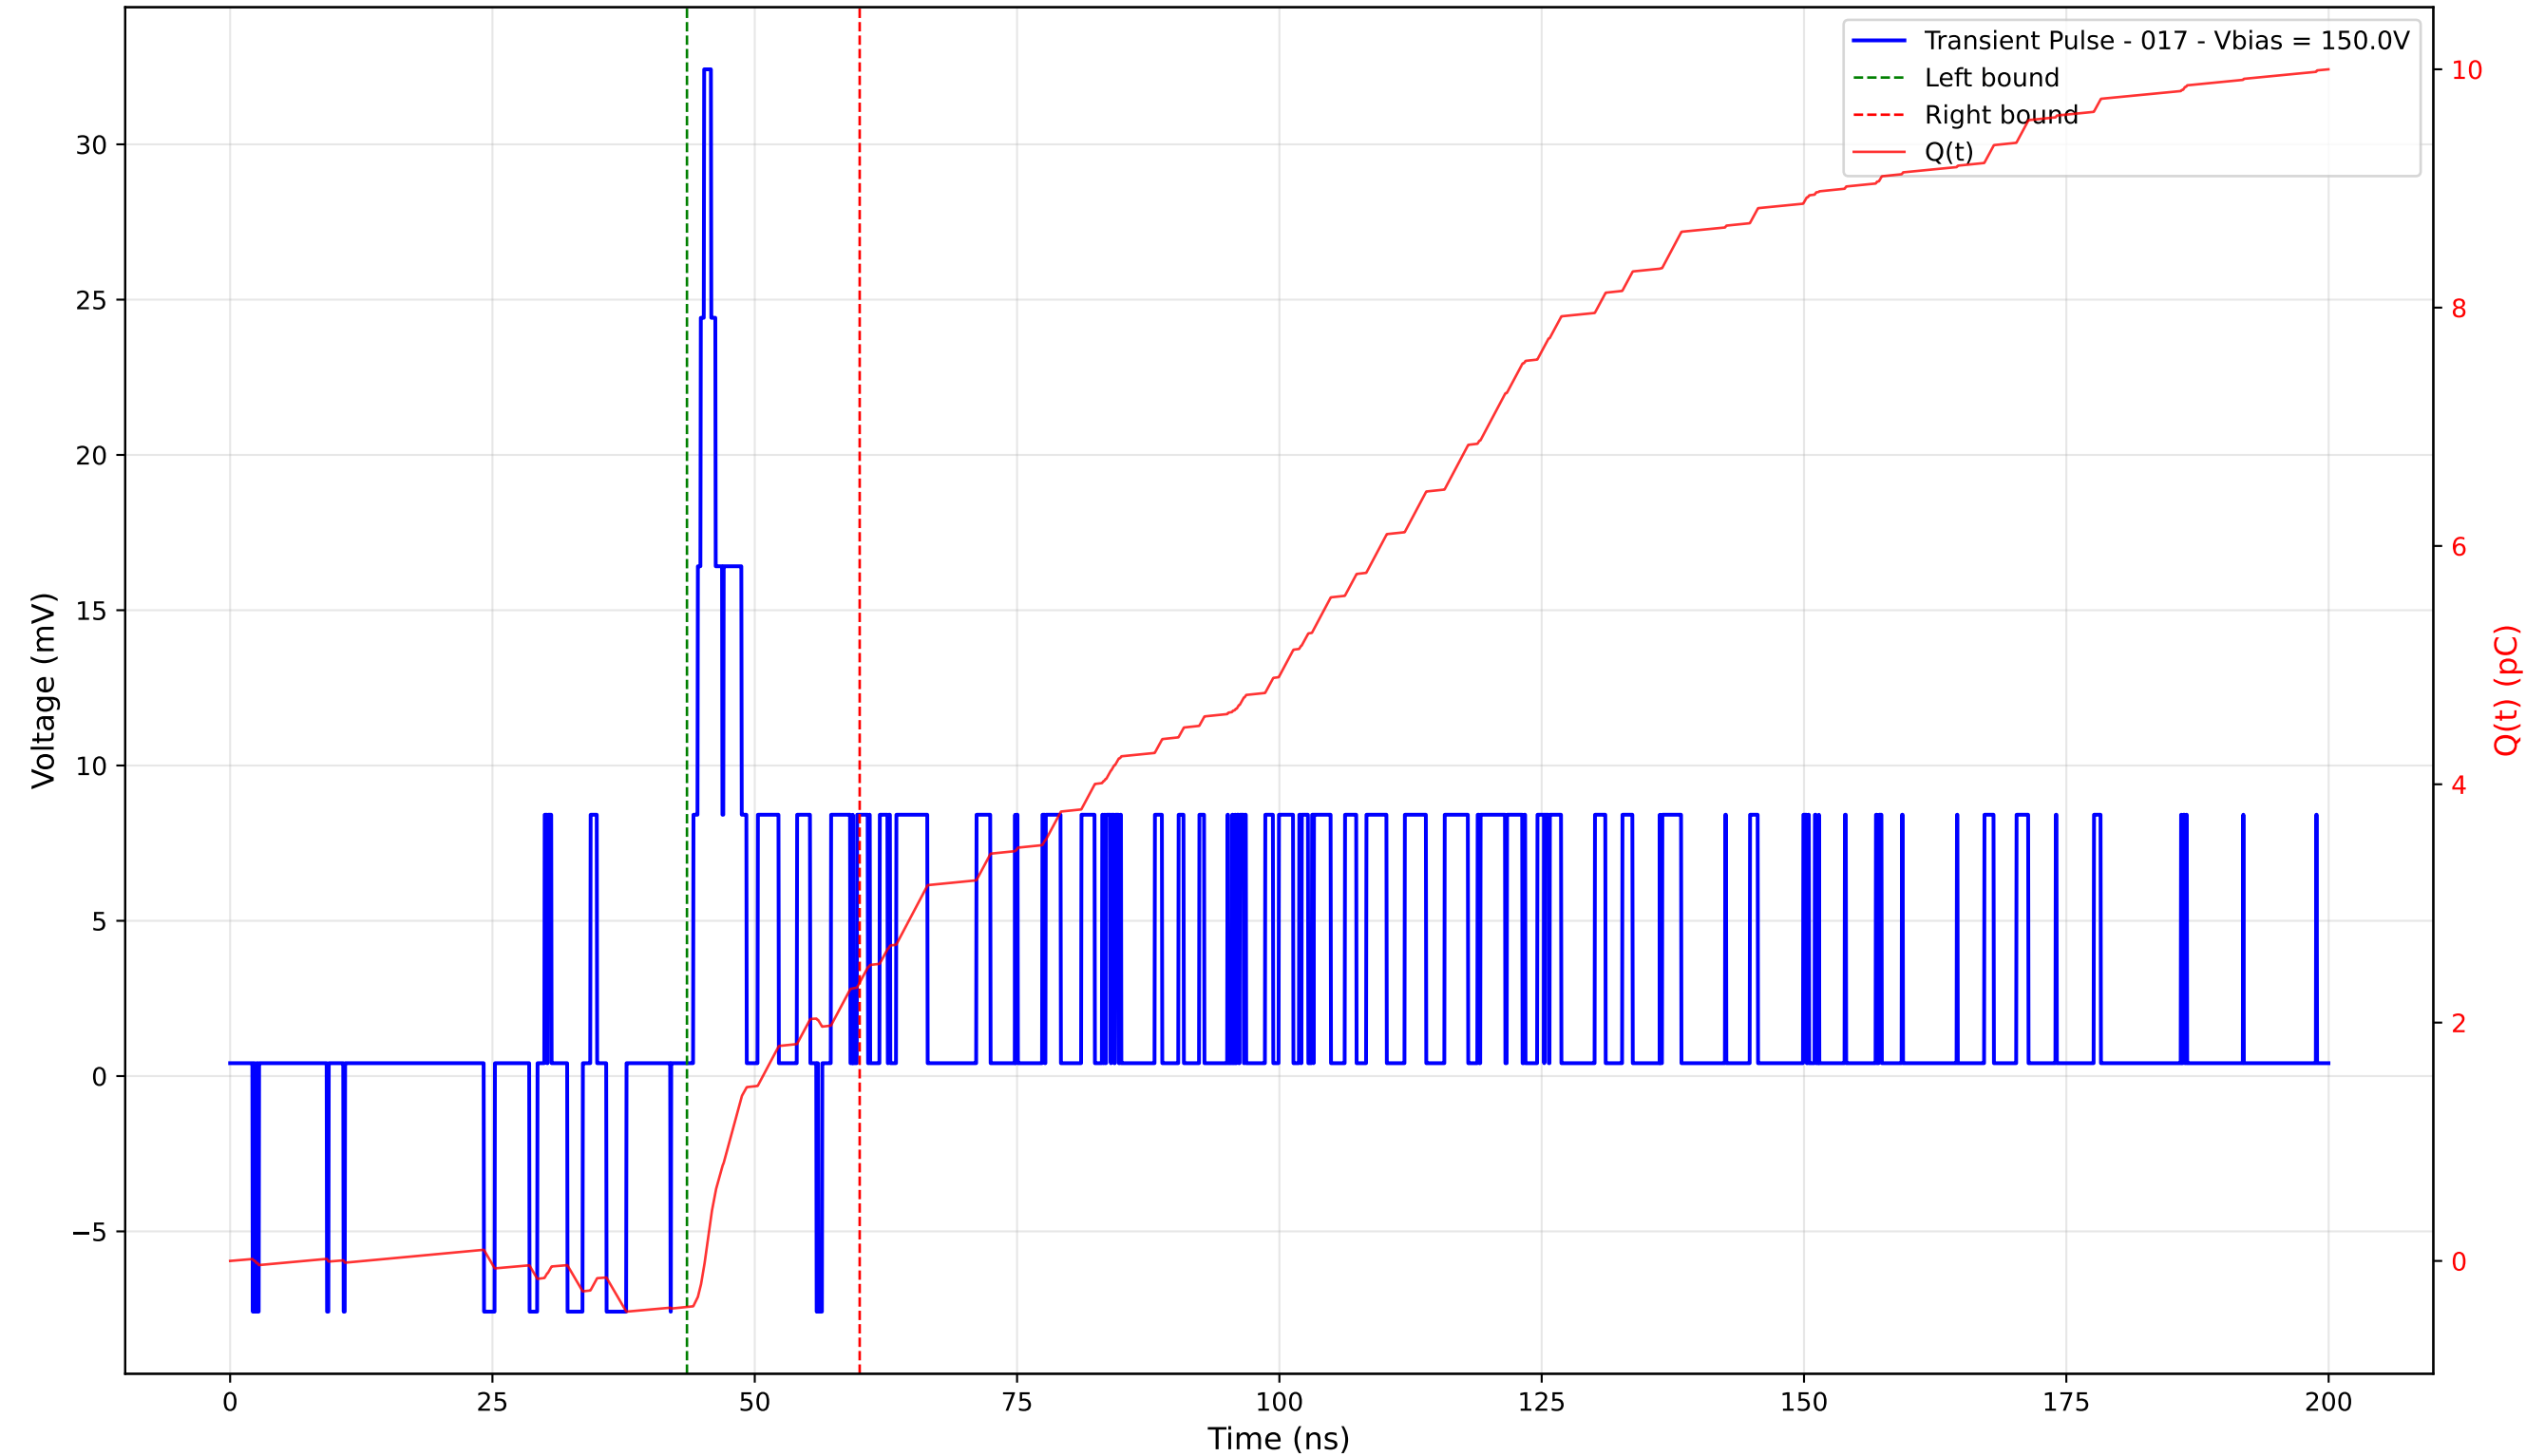


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 3.84 pC - Rise Time: 0.00 ns (N/A)

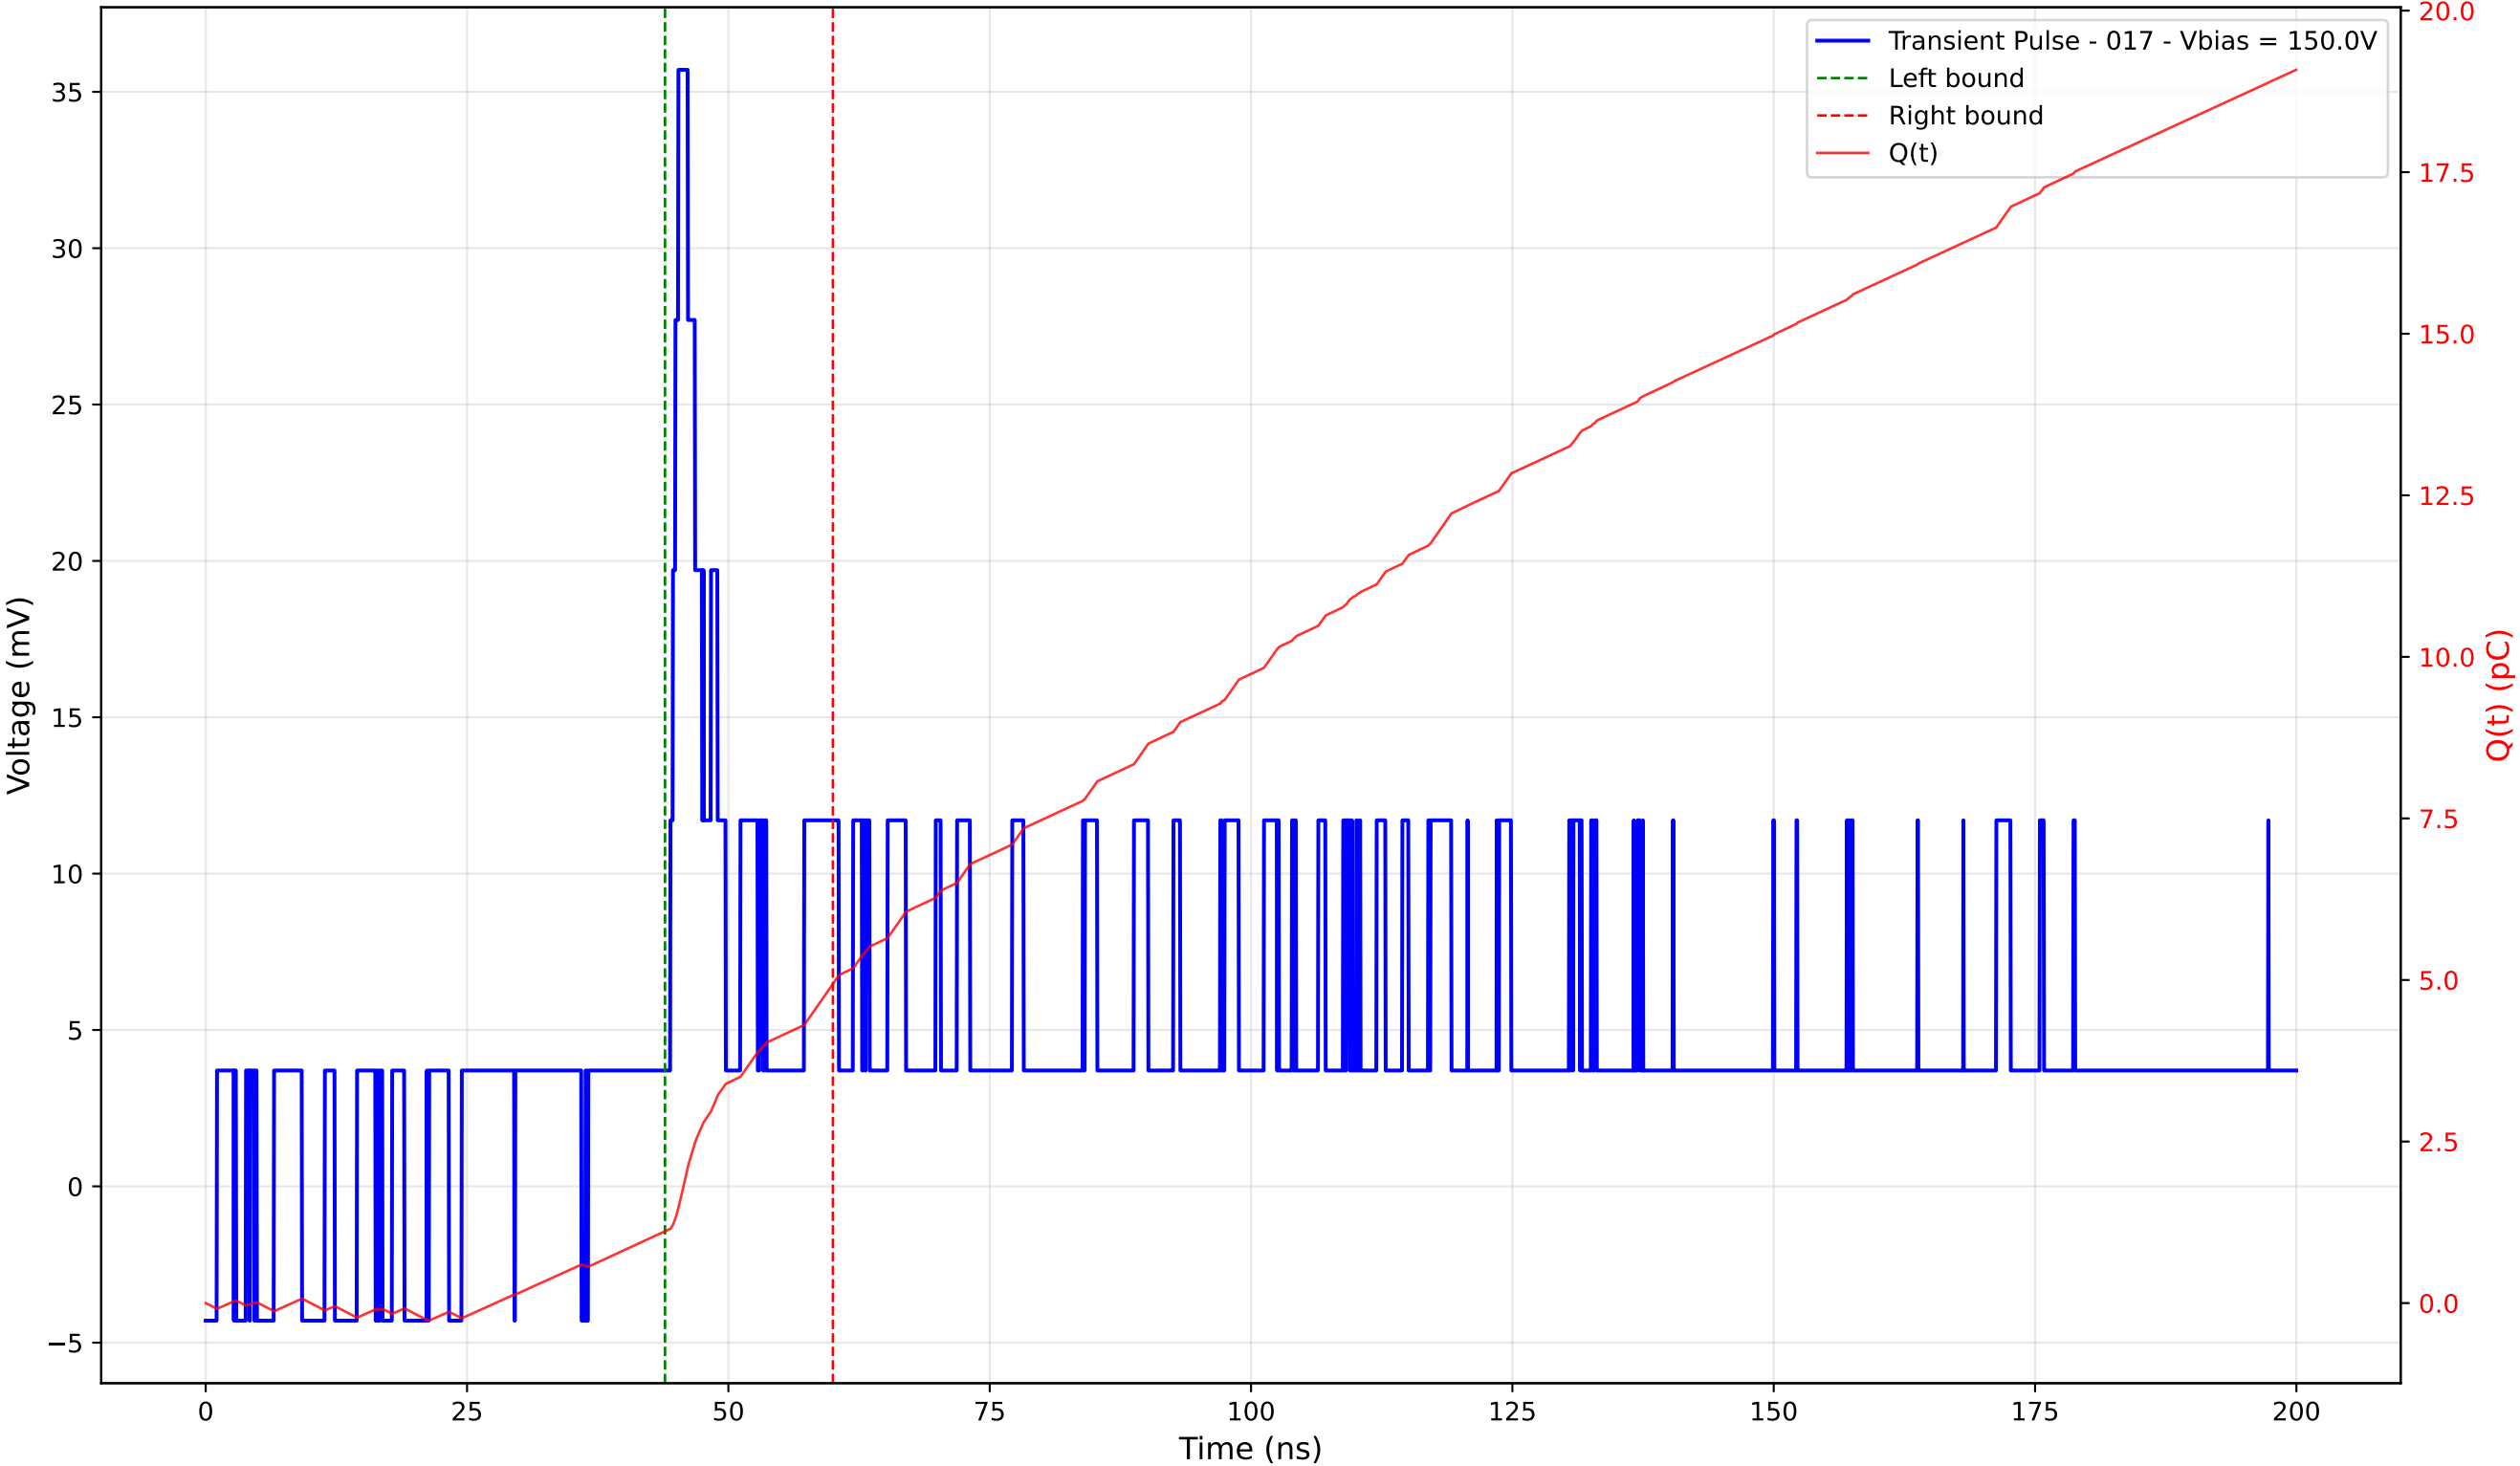


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 3.41 pC - Rise Time: 0.00 ns (N/A)

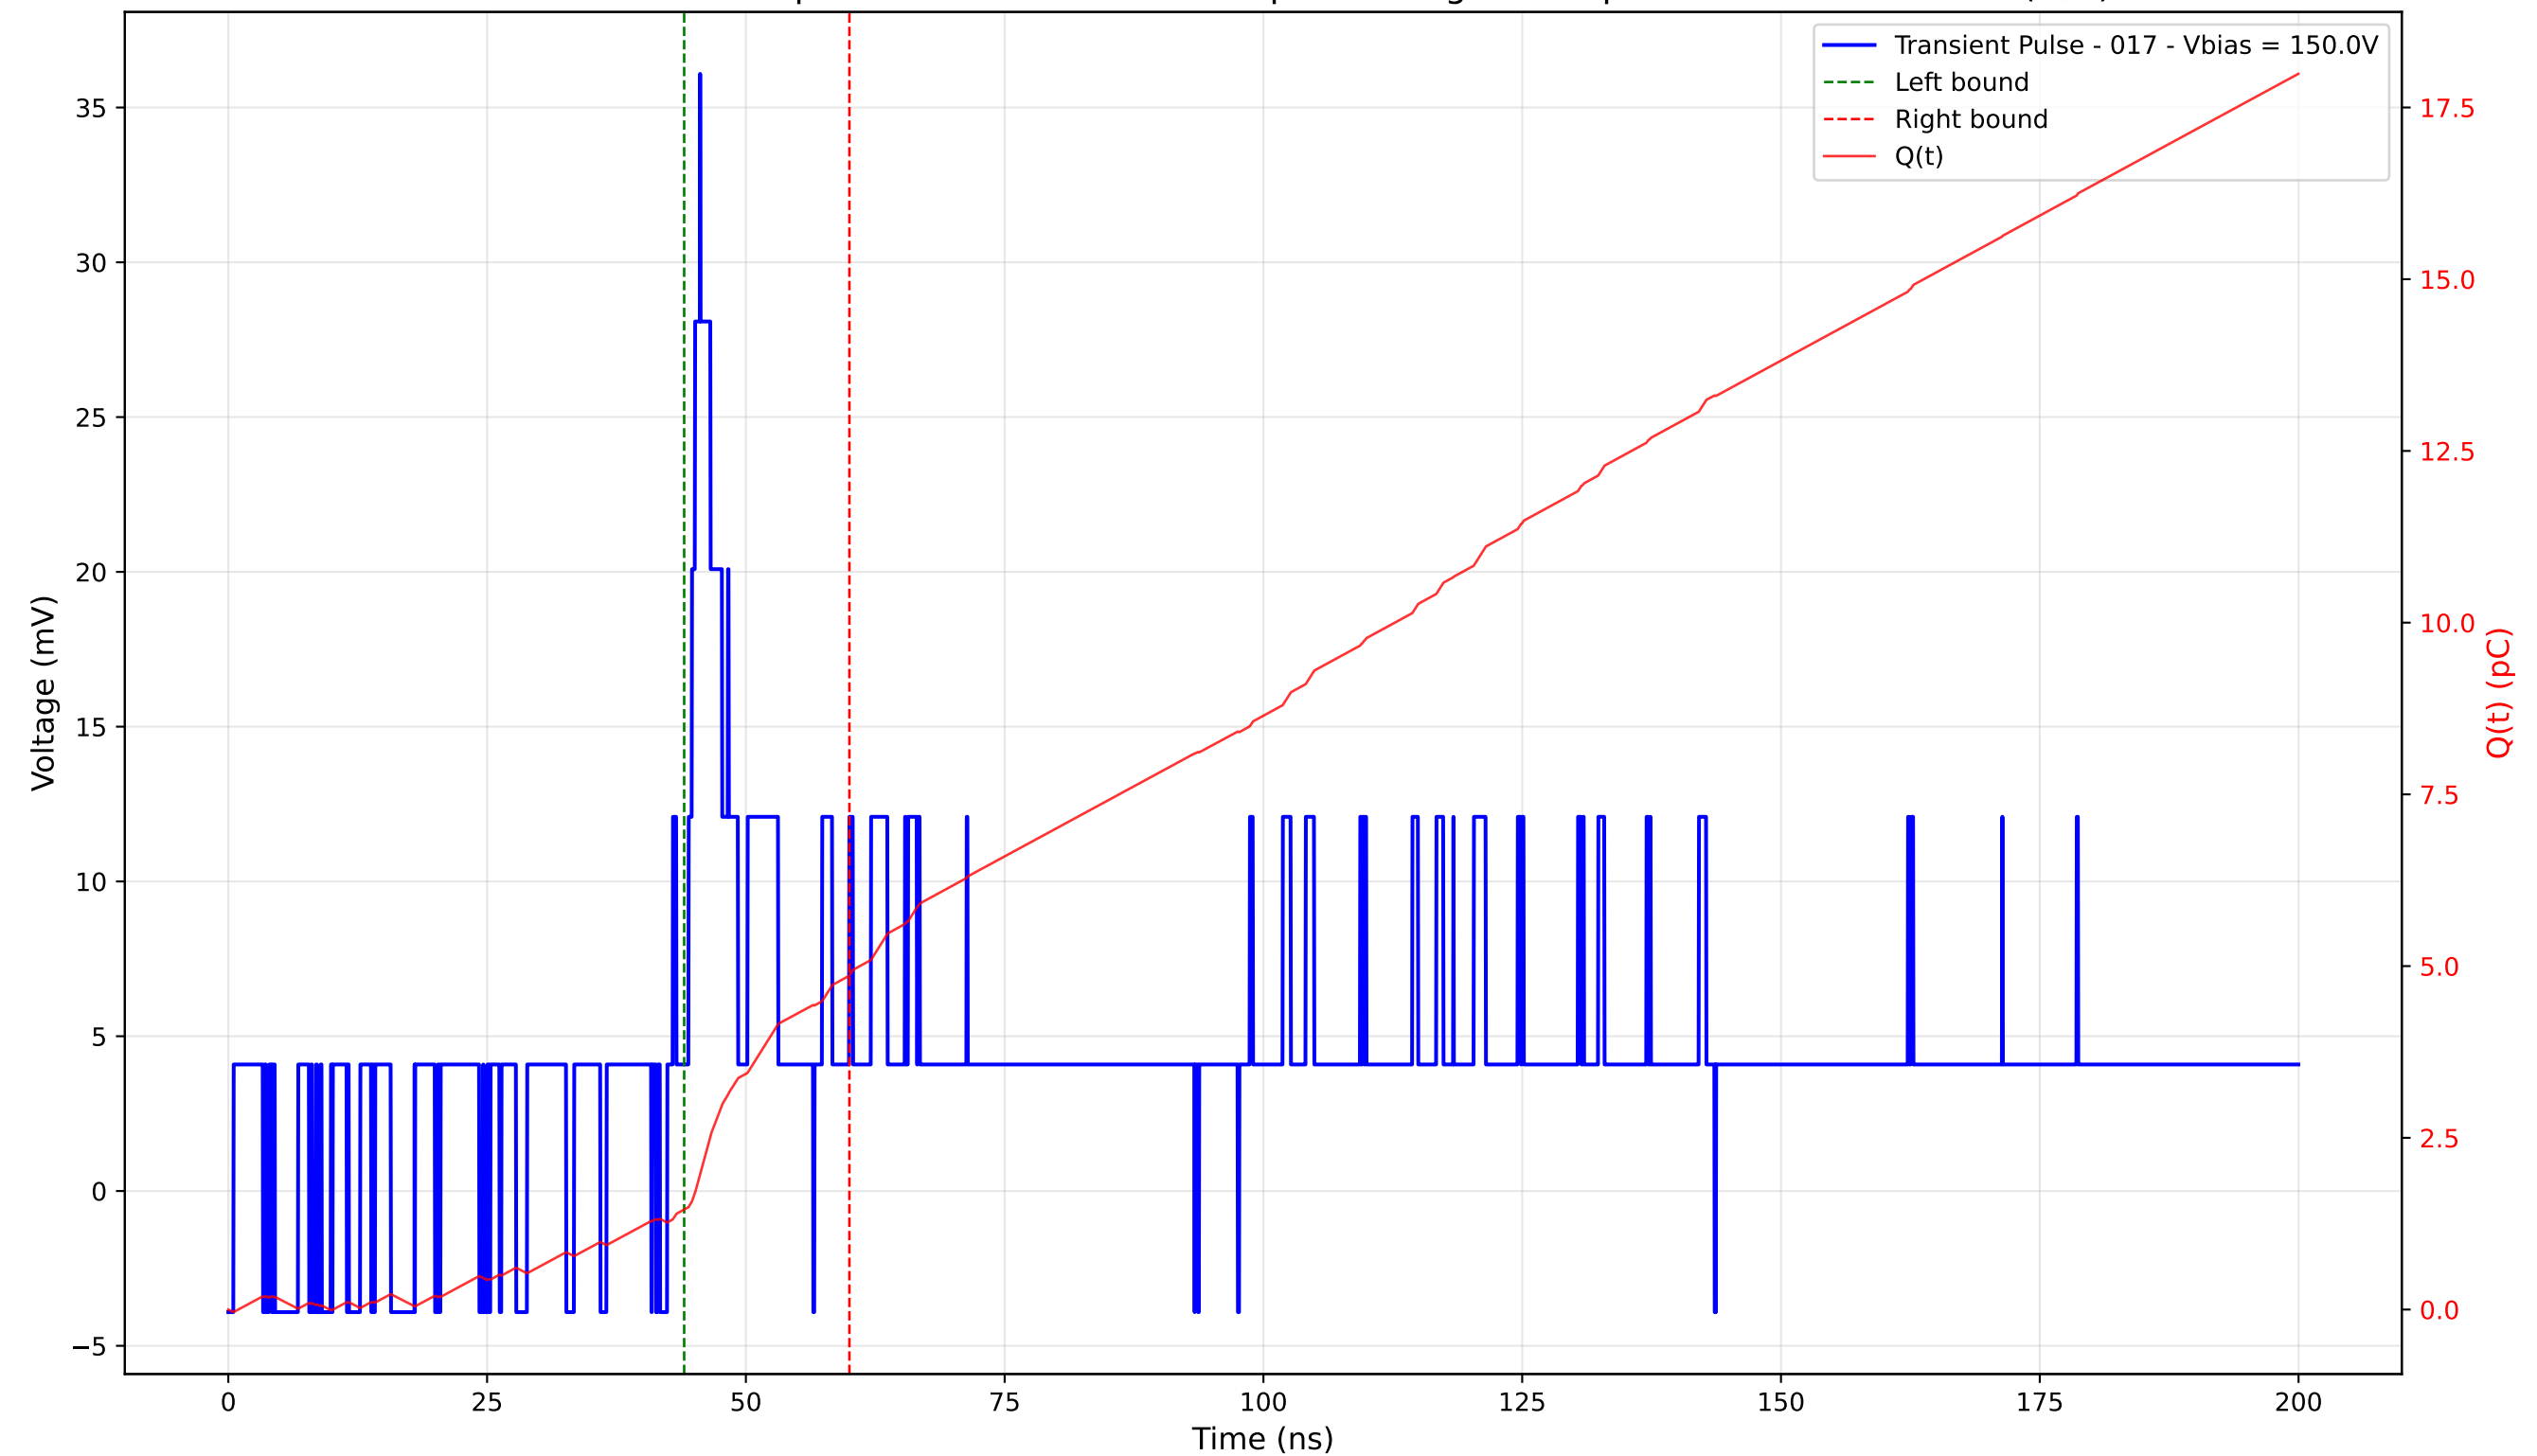


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 3.27 pC - Rise Time: 2.90 ns

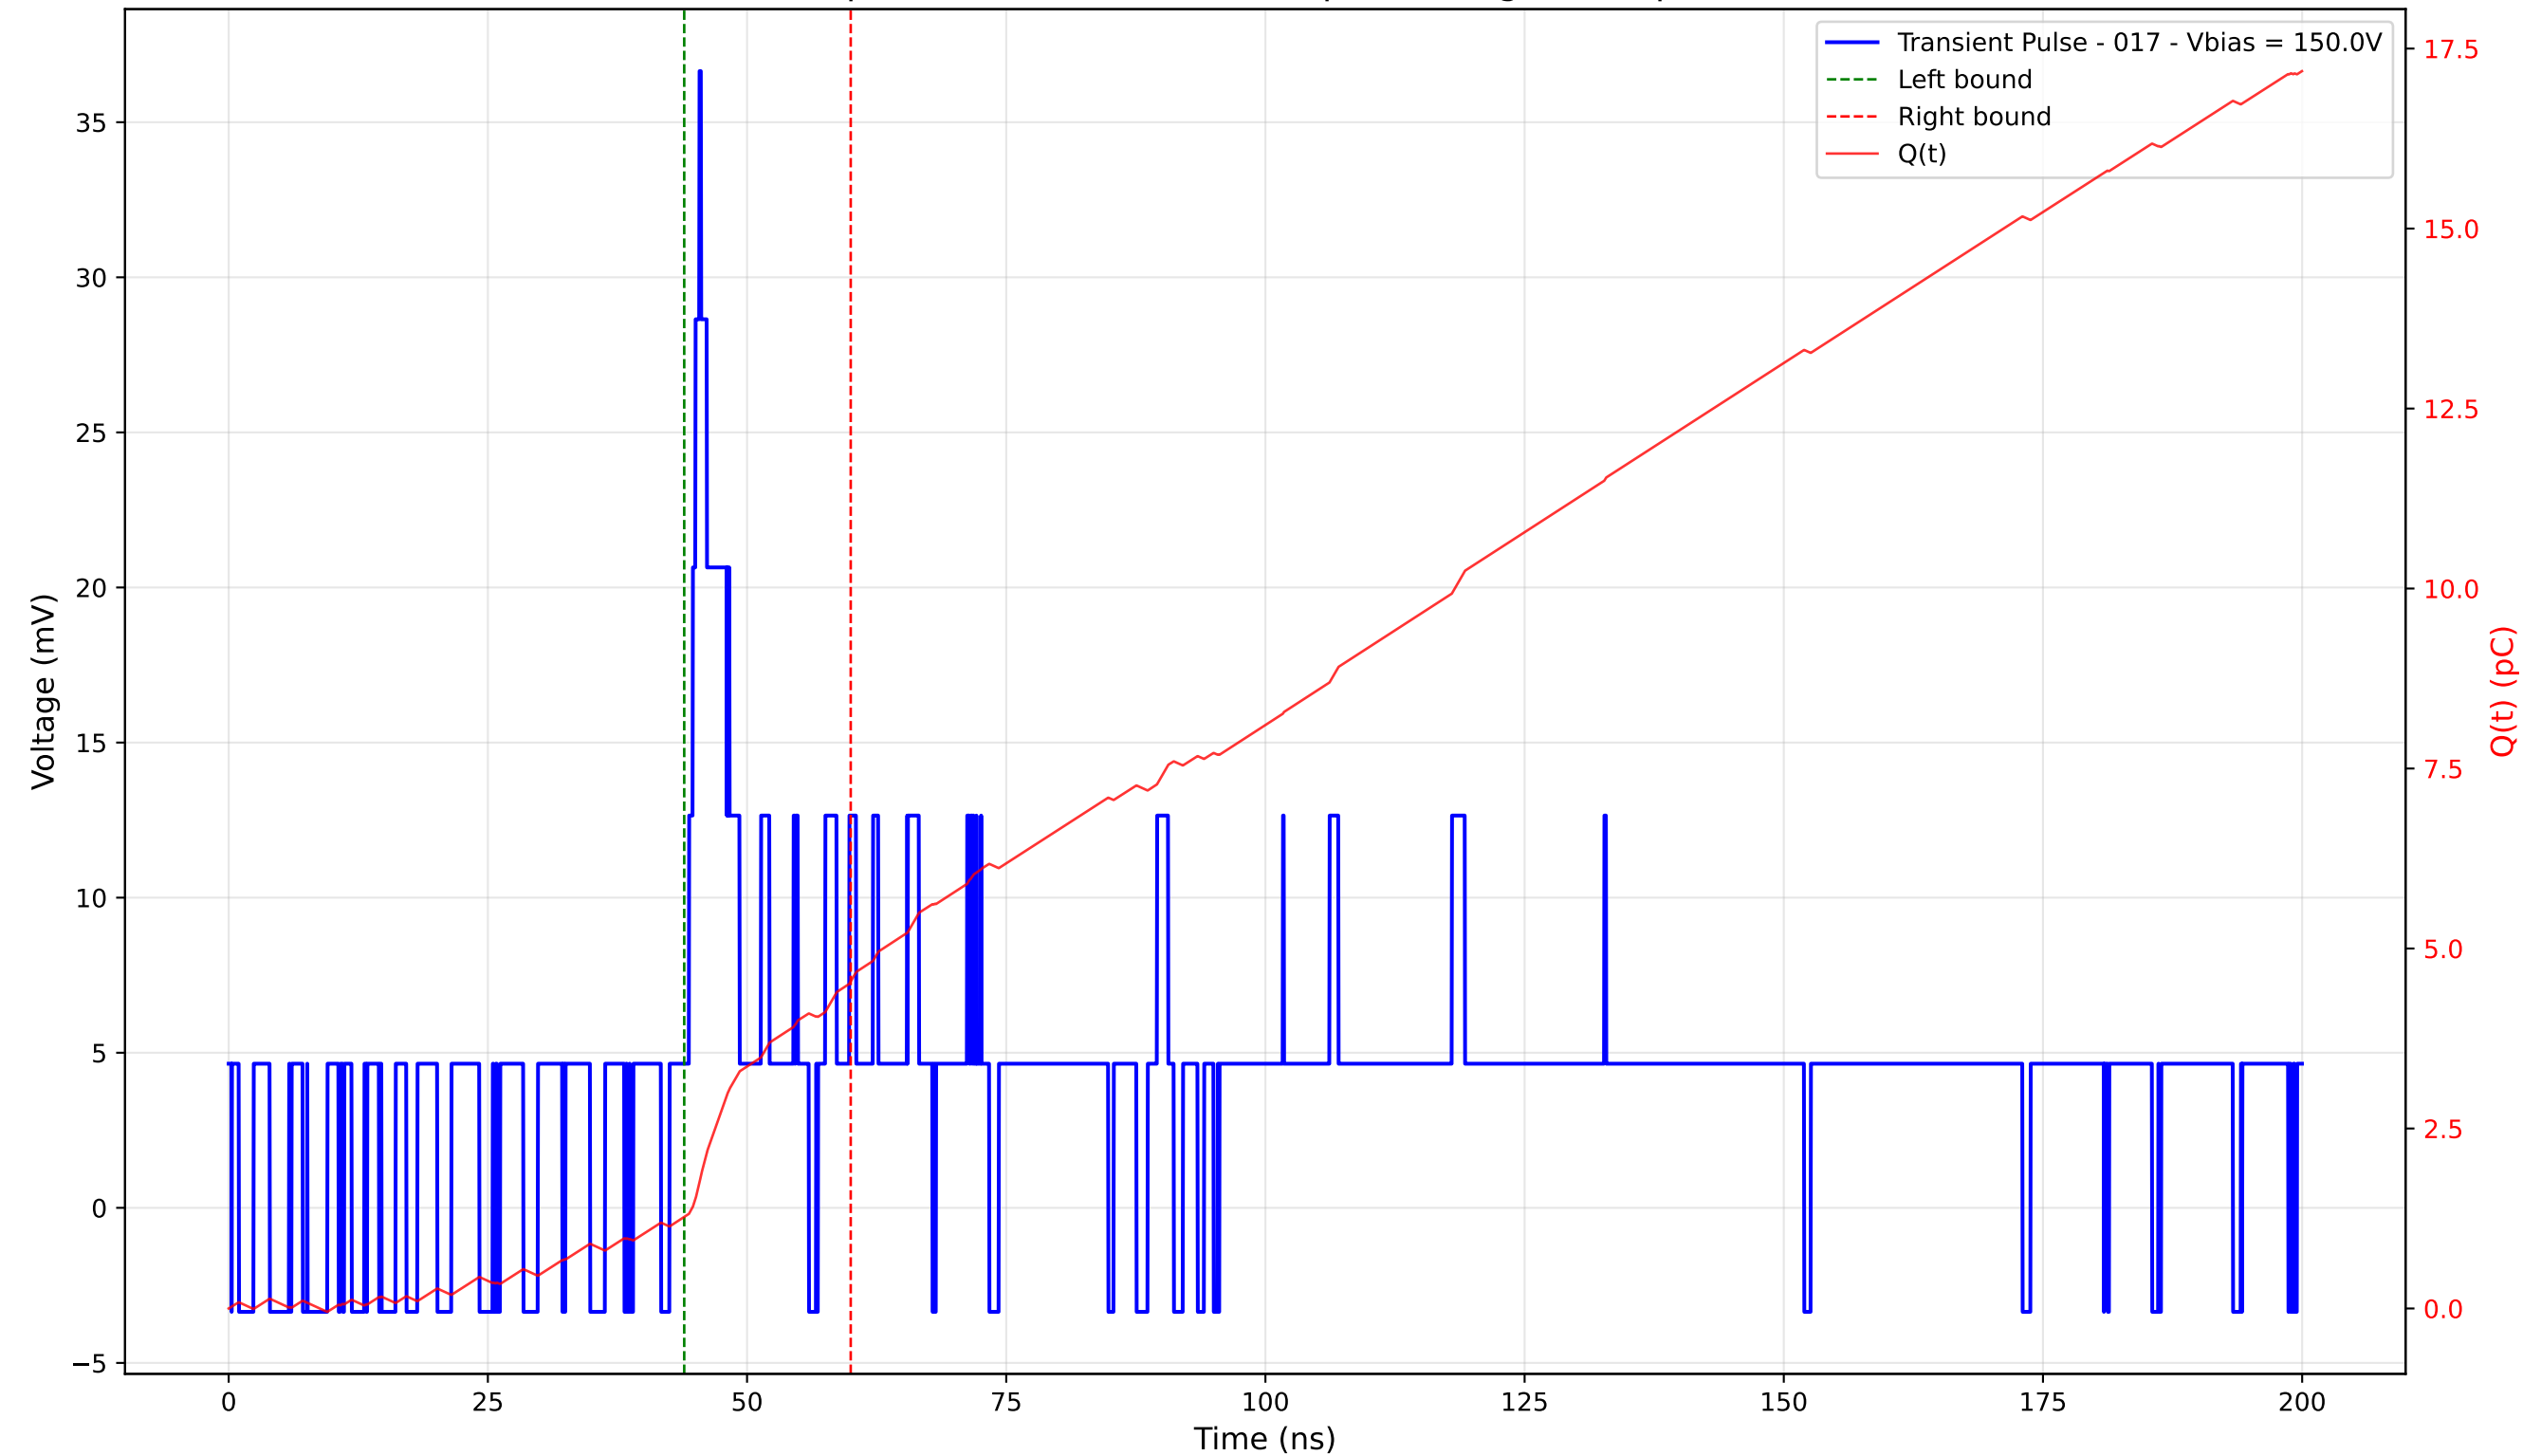


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 3.61 pC - Rise Time: 0.00 ns (N/A)

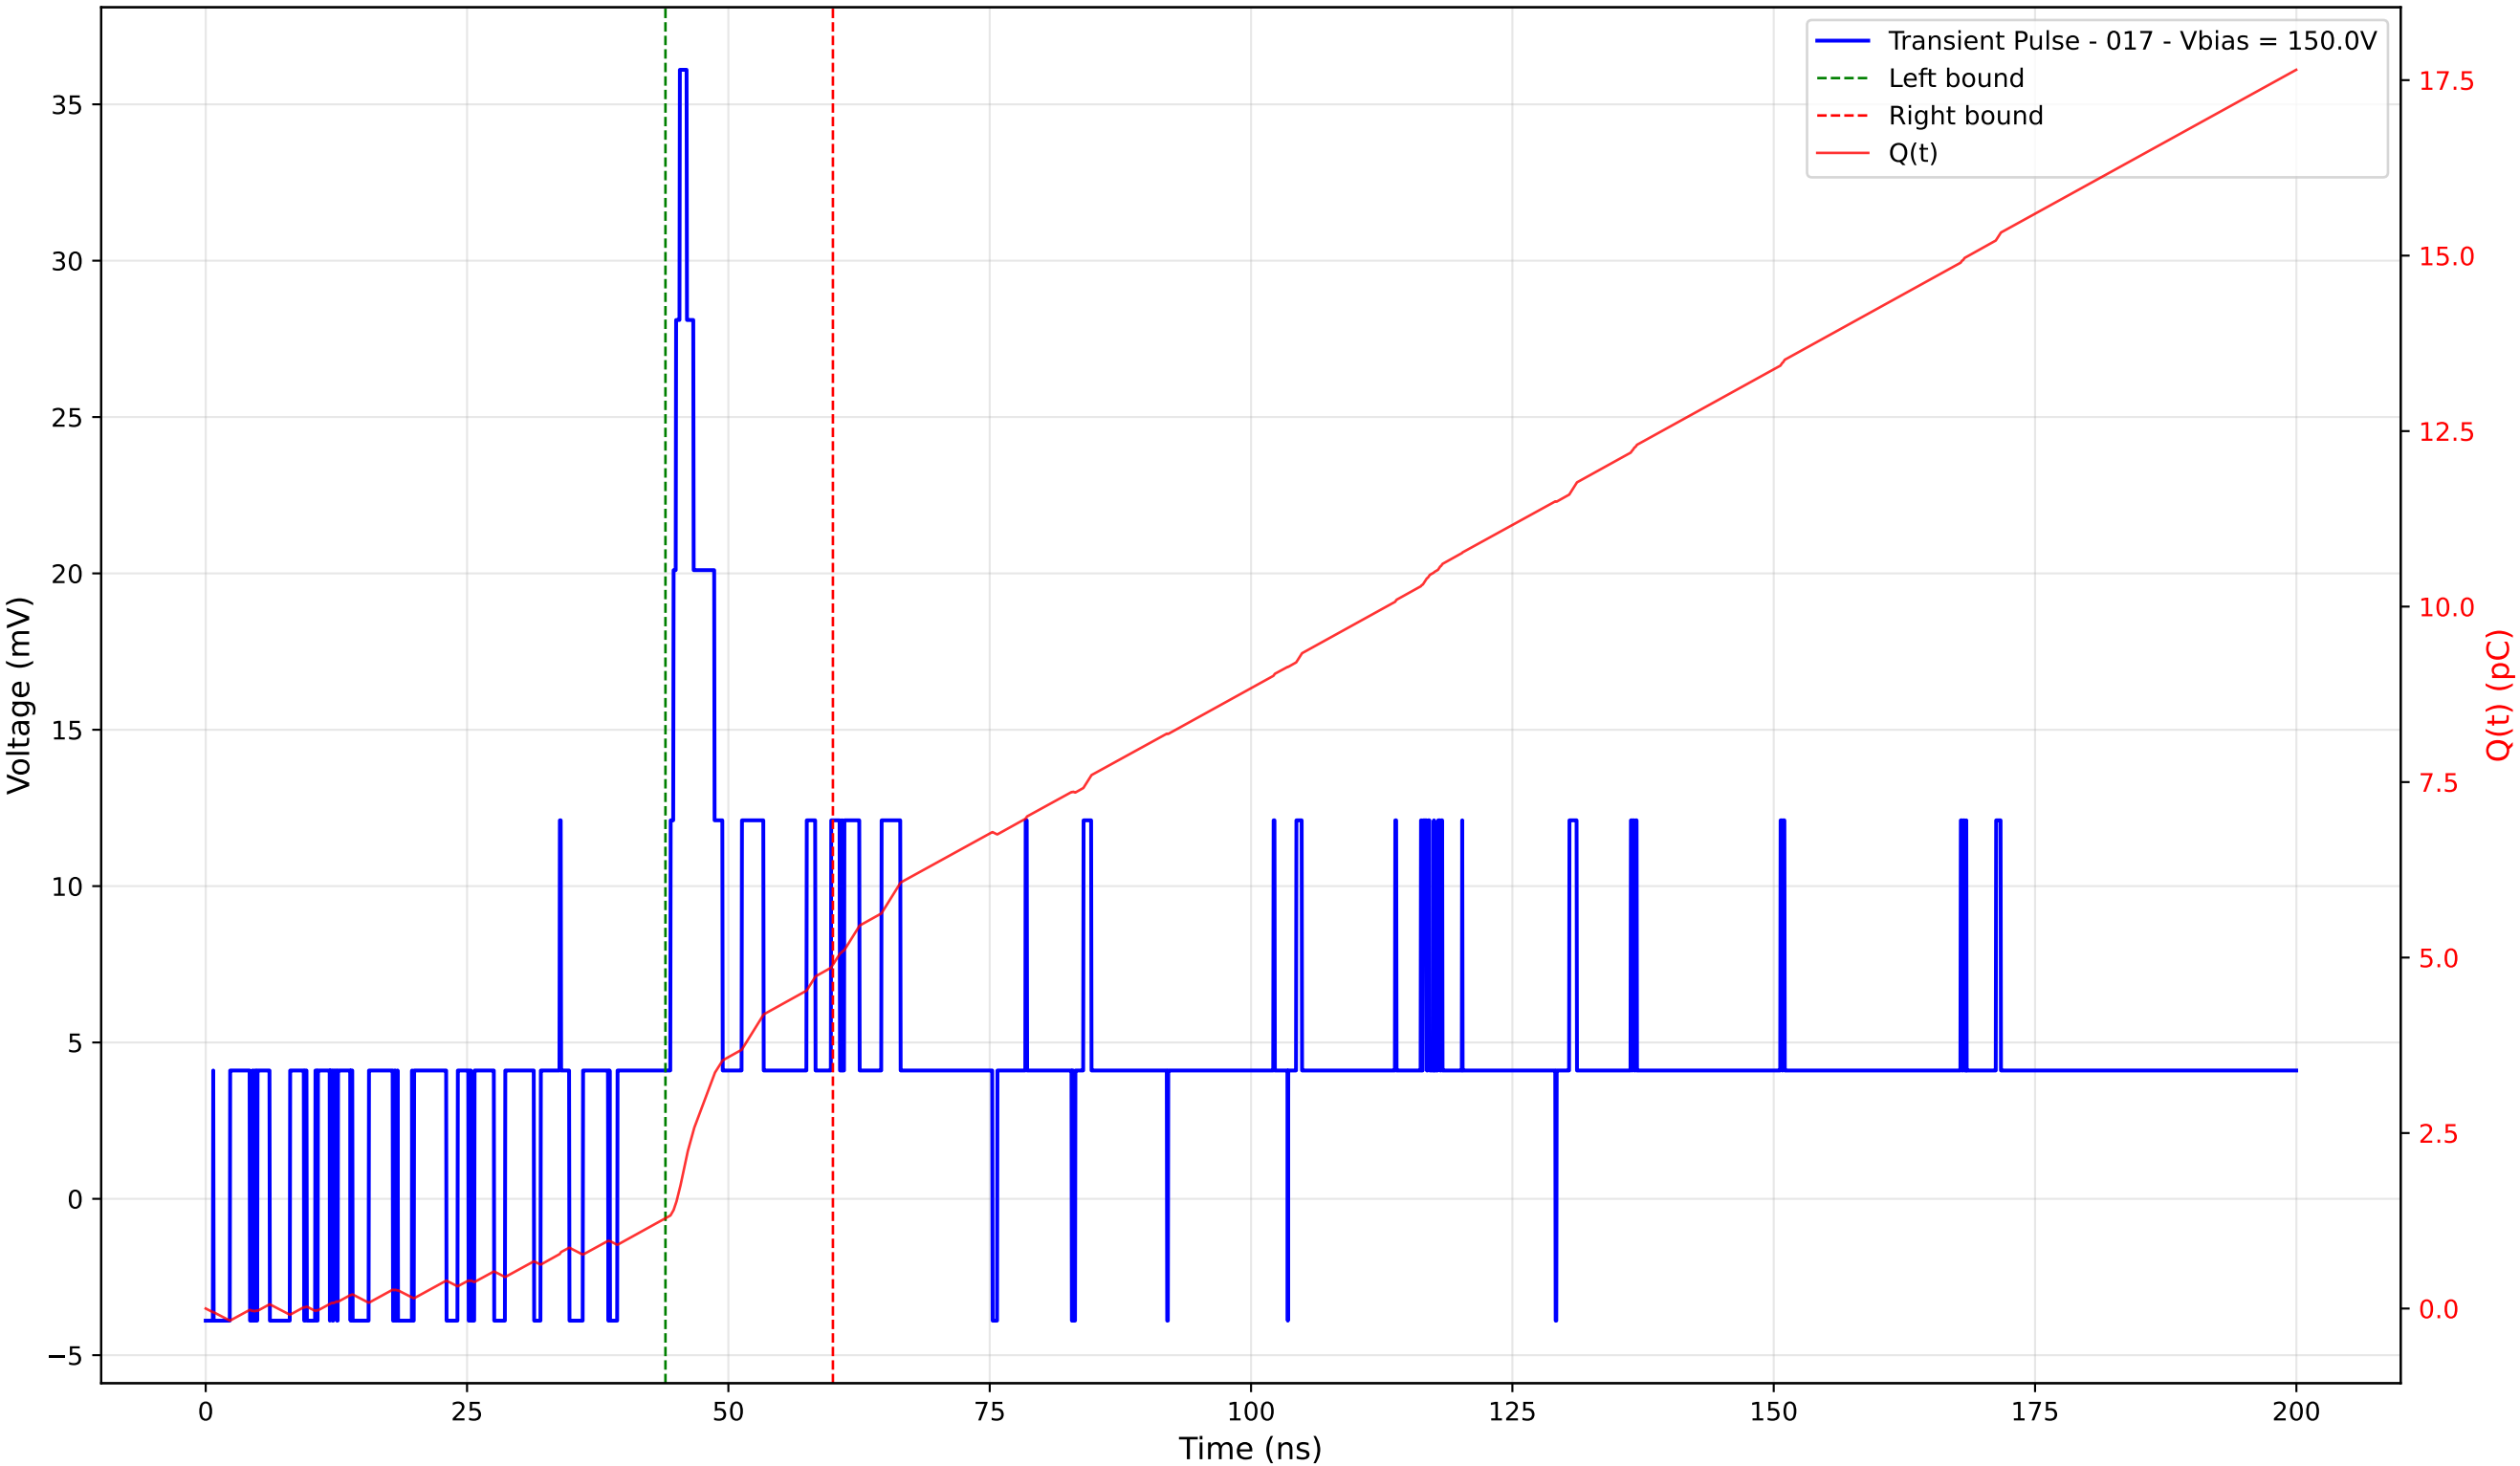


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 4.06 pC - Rise Time: 0.00 ns (N/A)

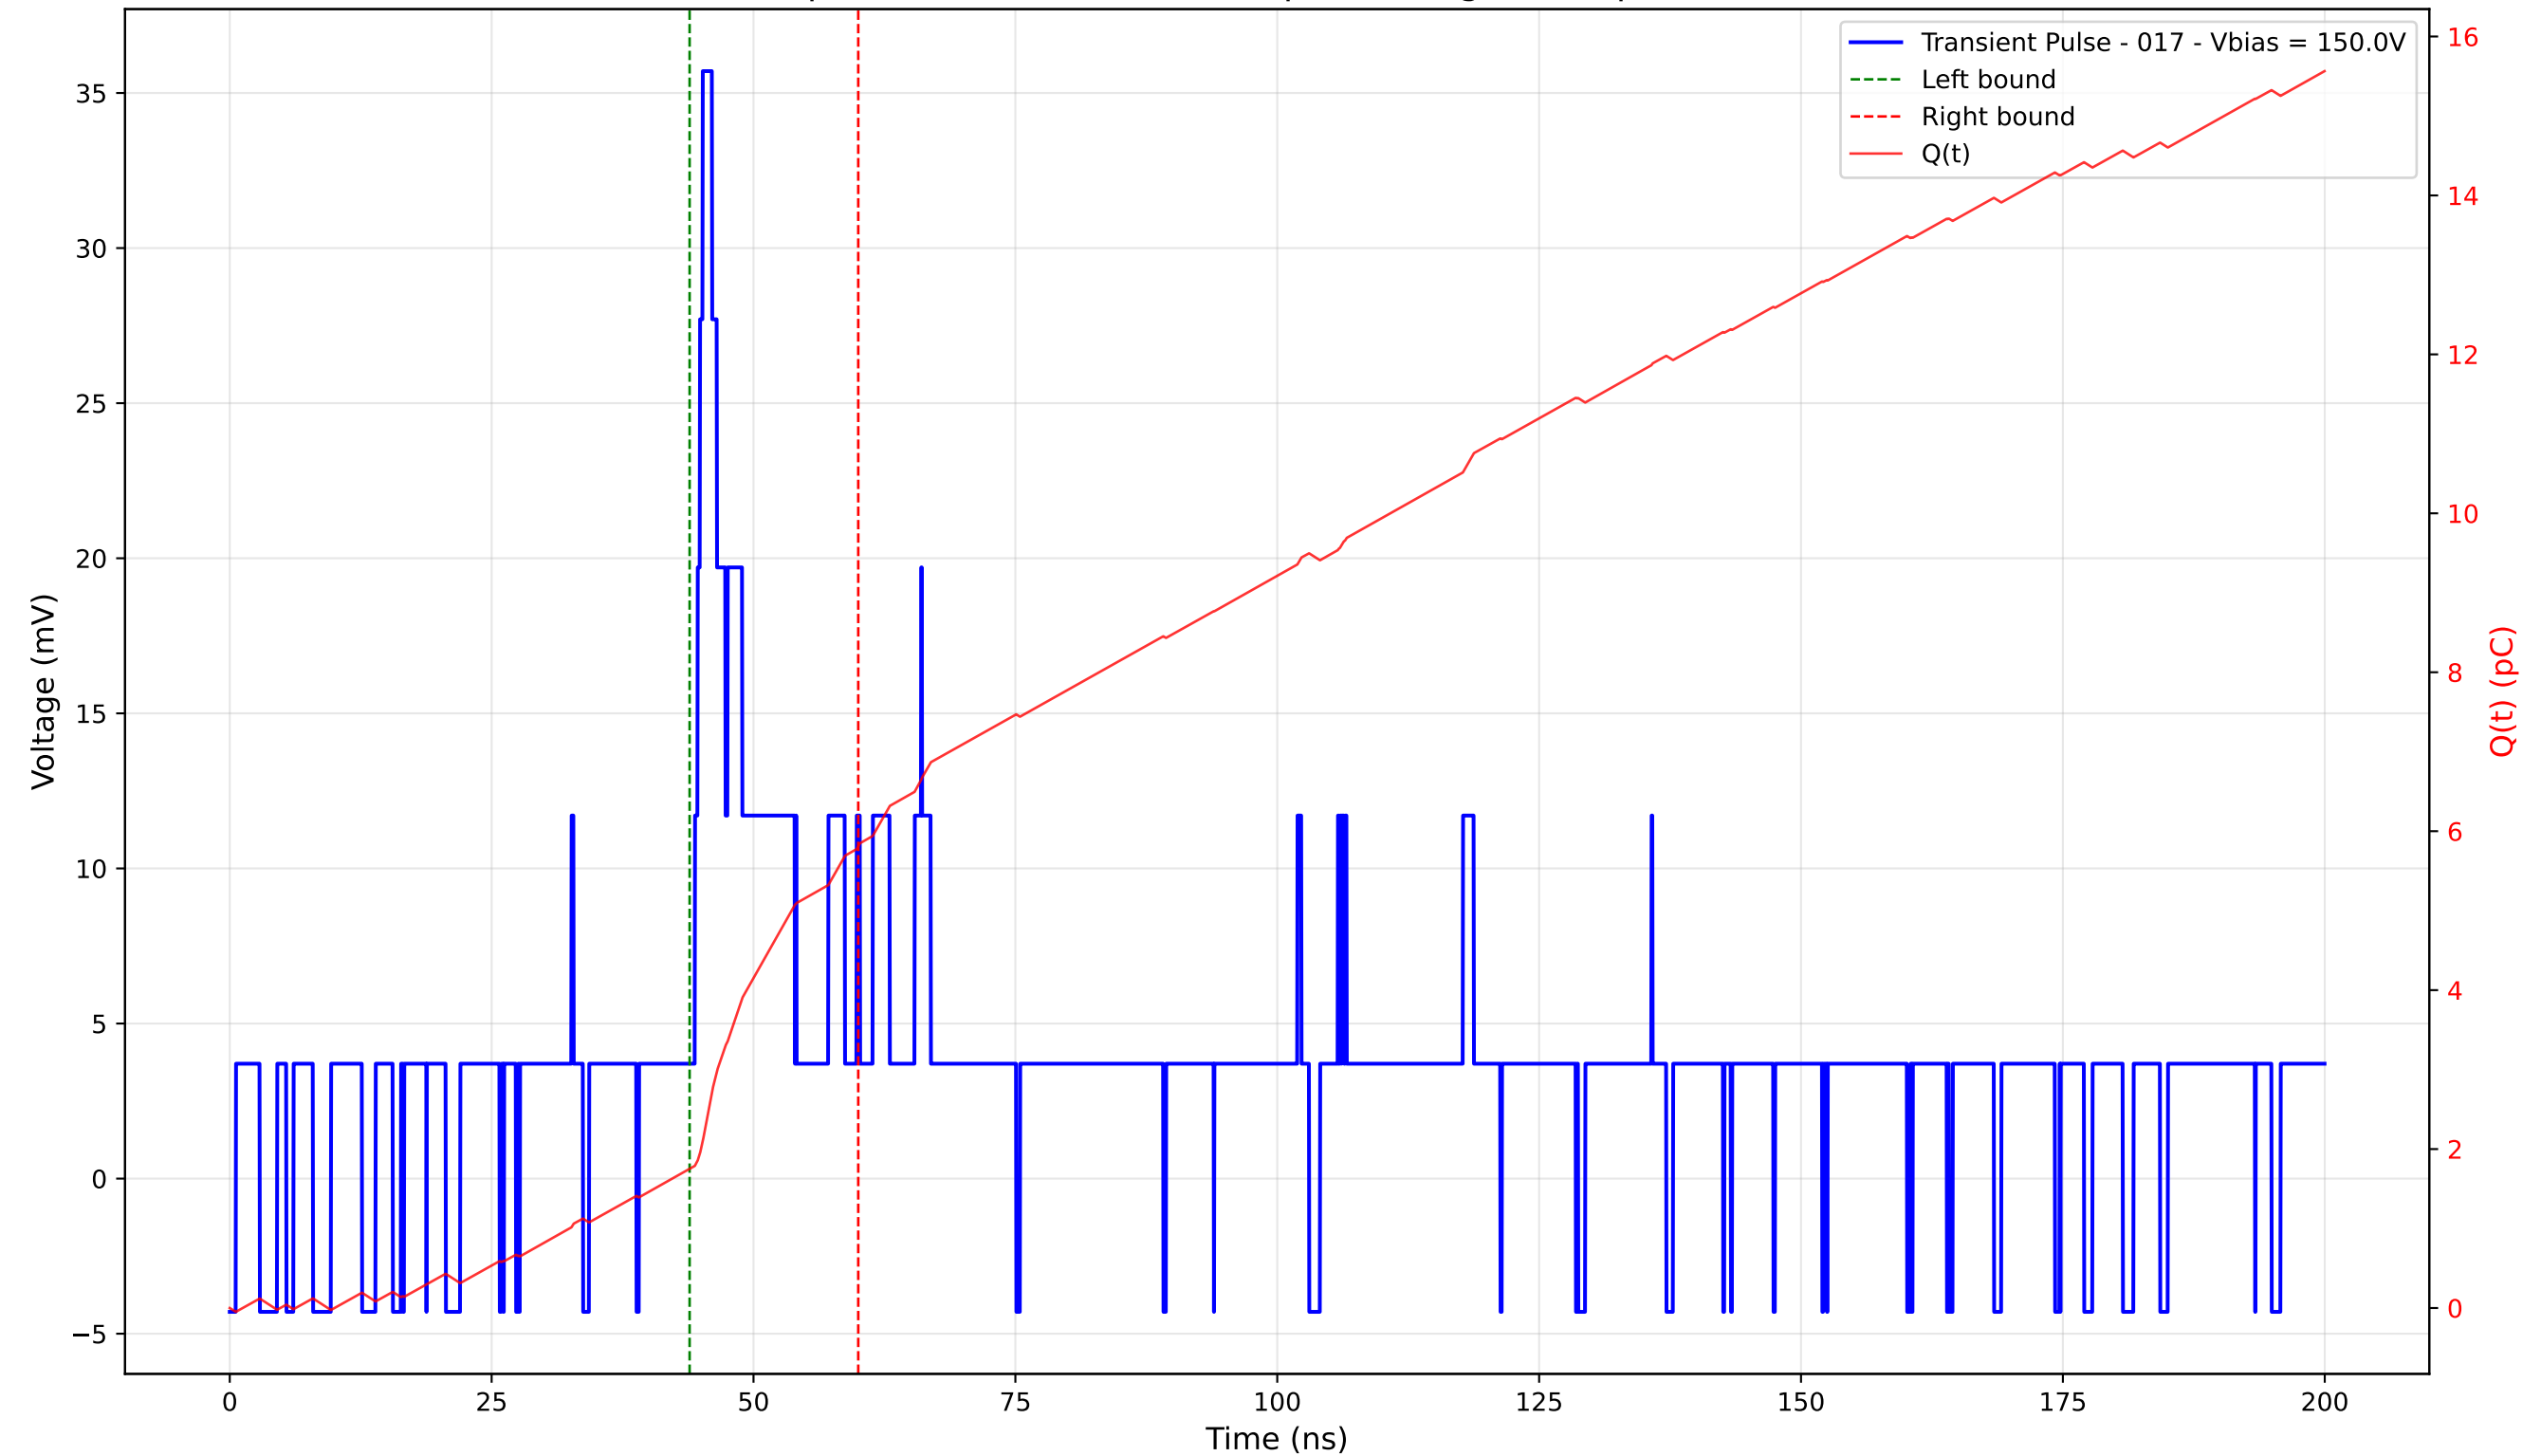


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 3.54 pC - Rise Time: 0.89 ns

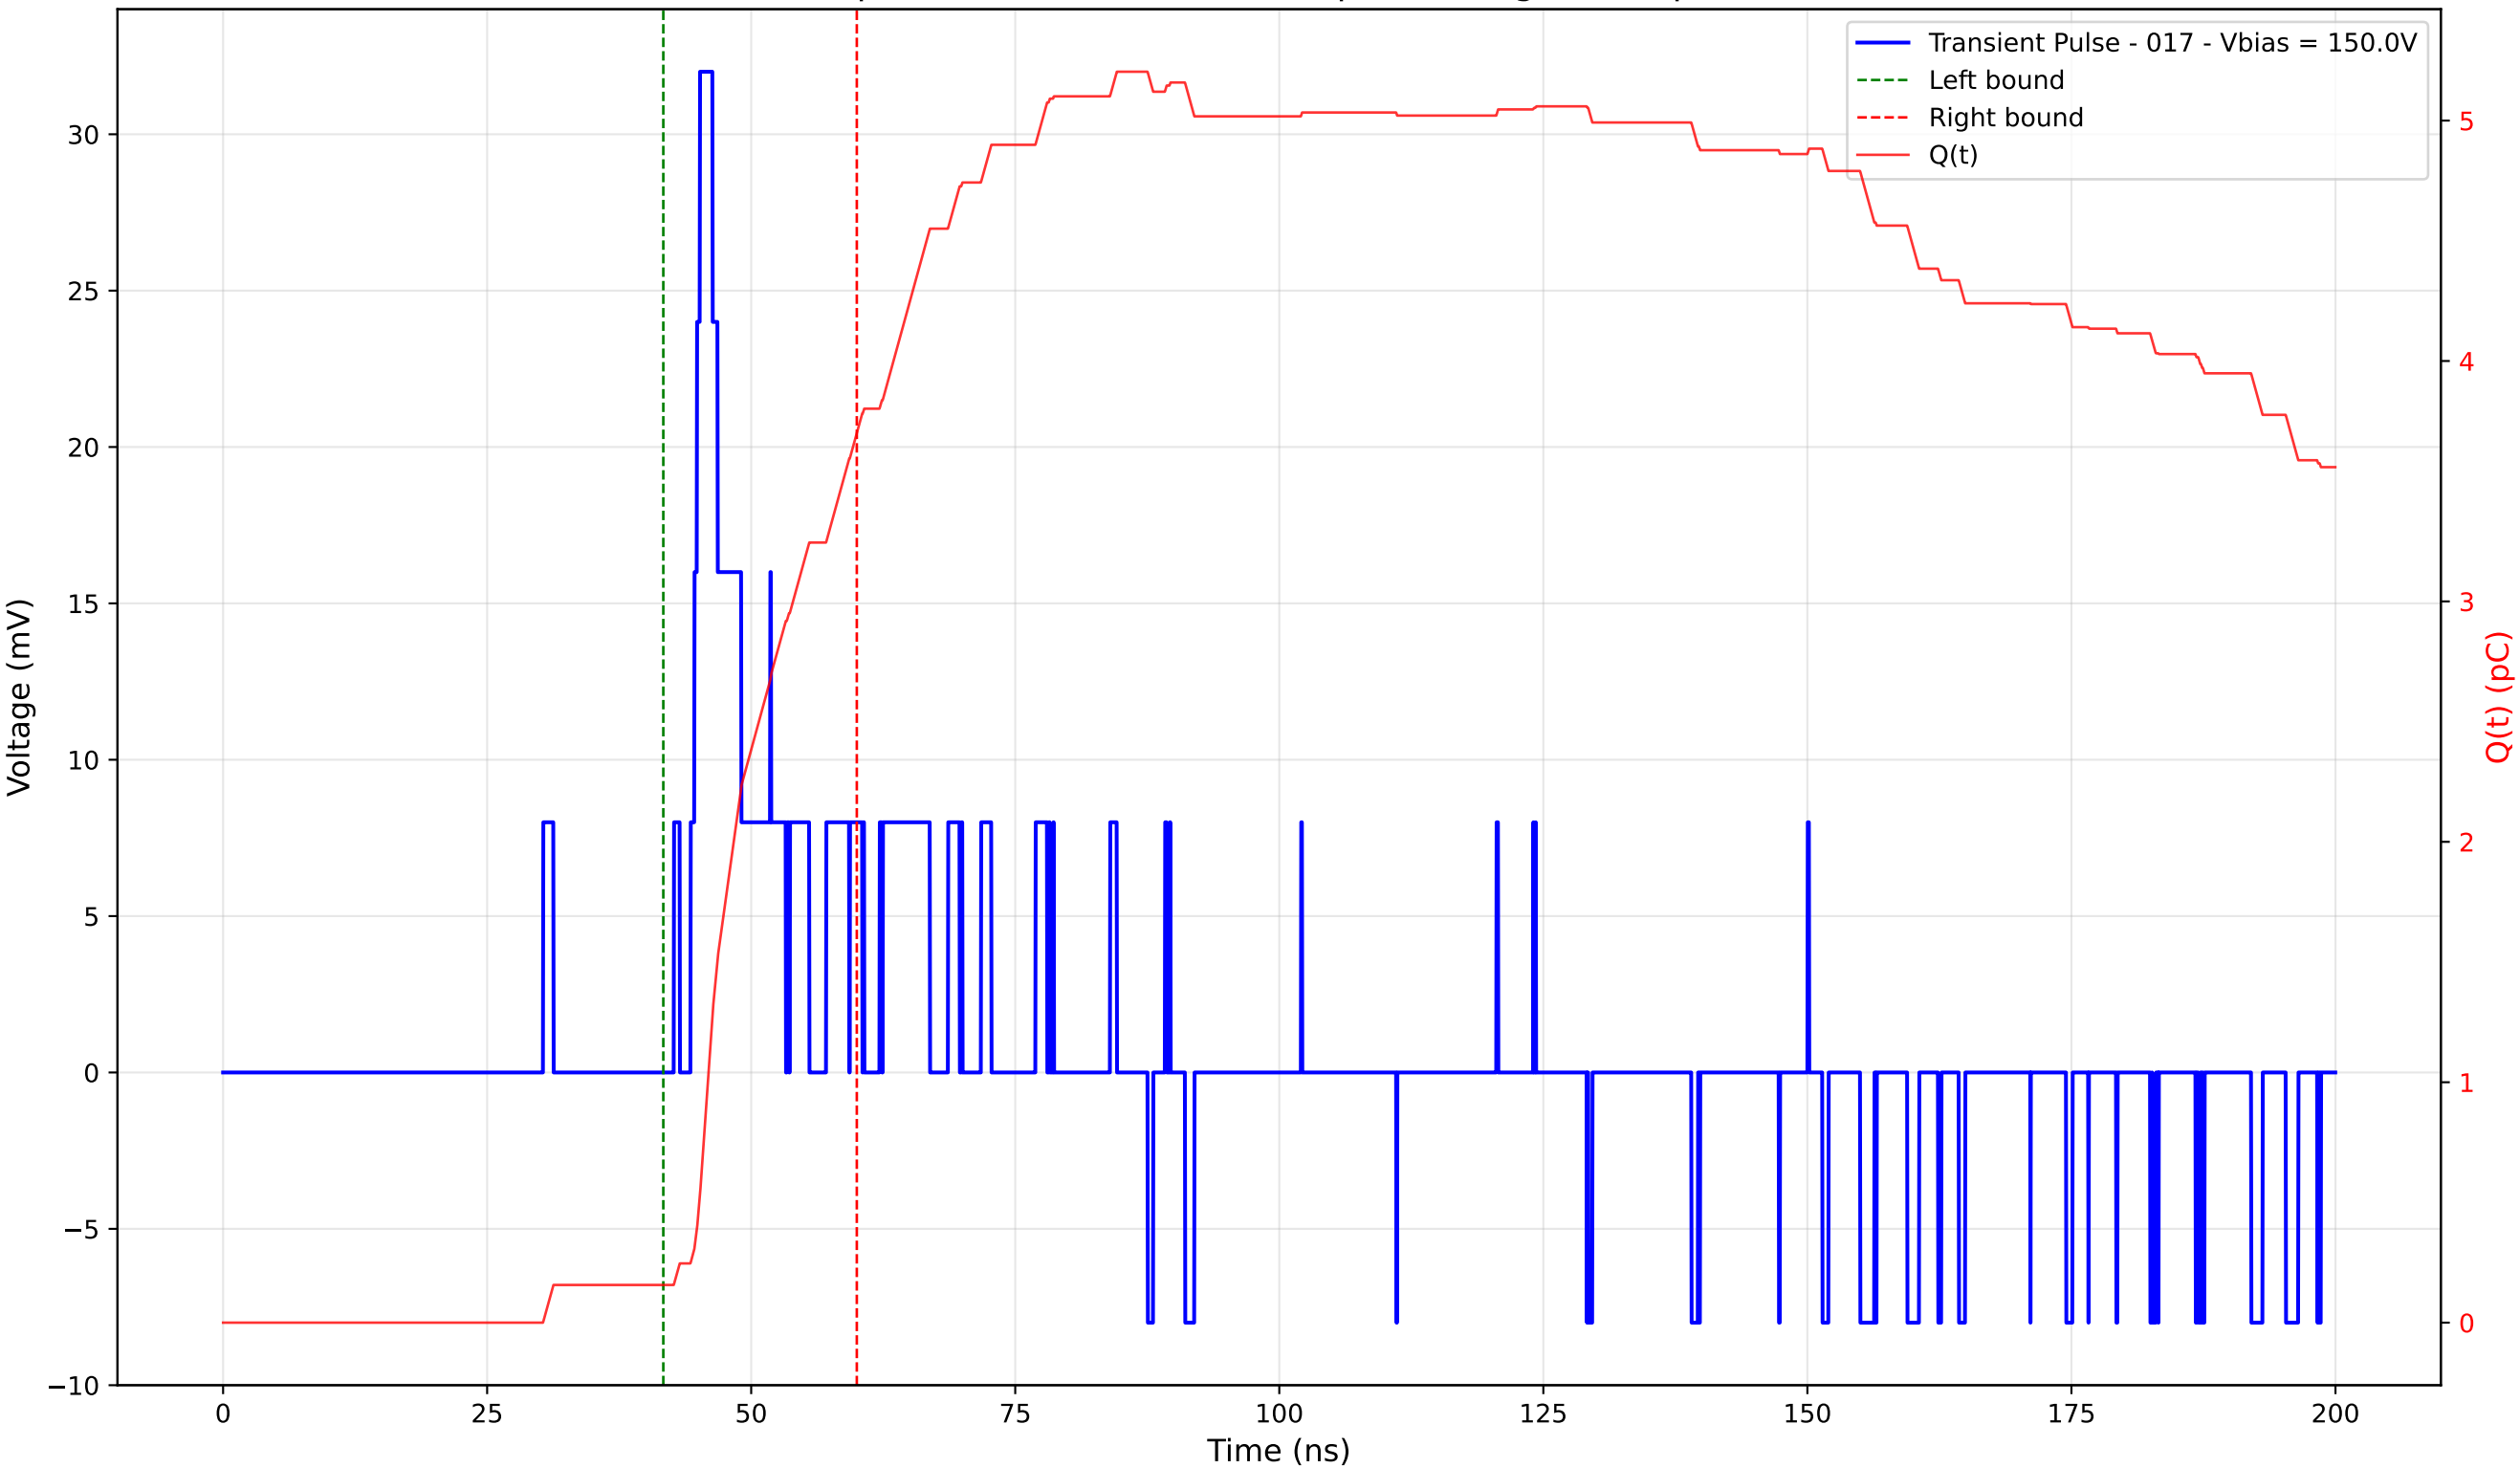


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 3.24 pC - Rise Time: 0.56 ns

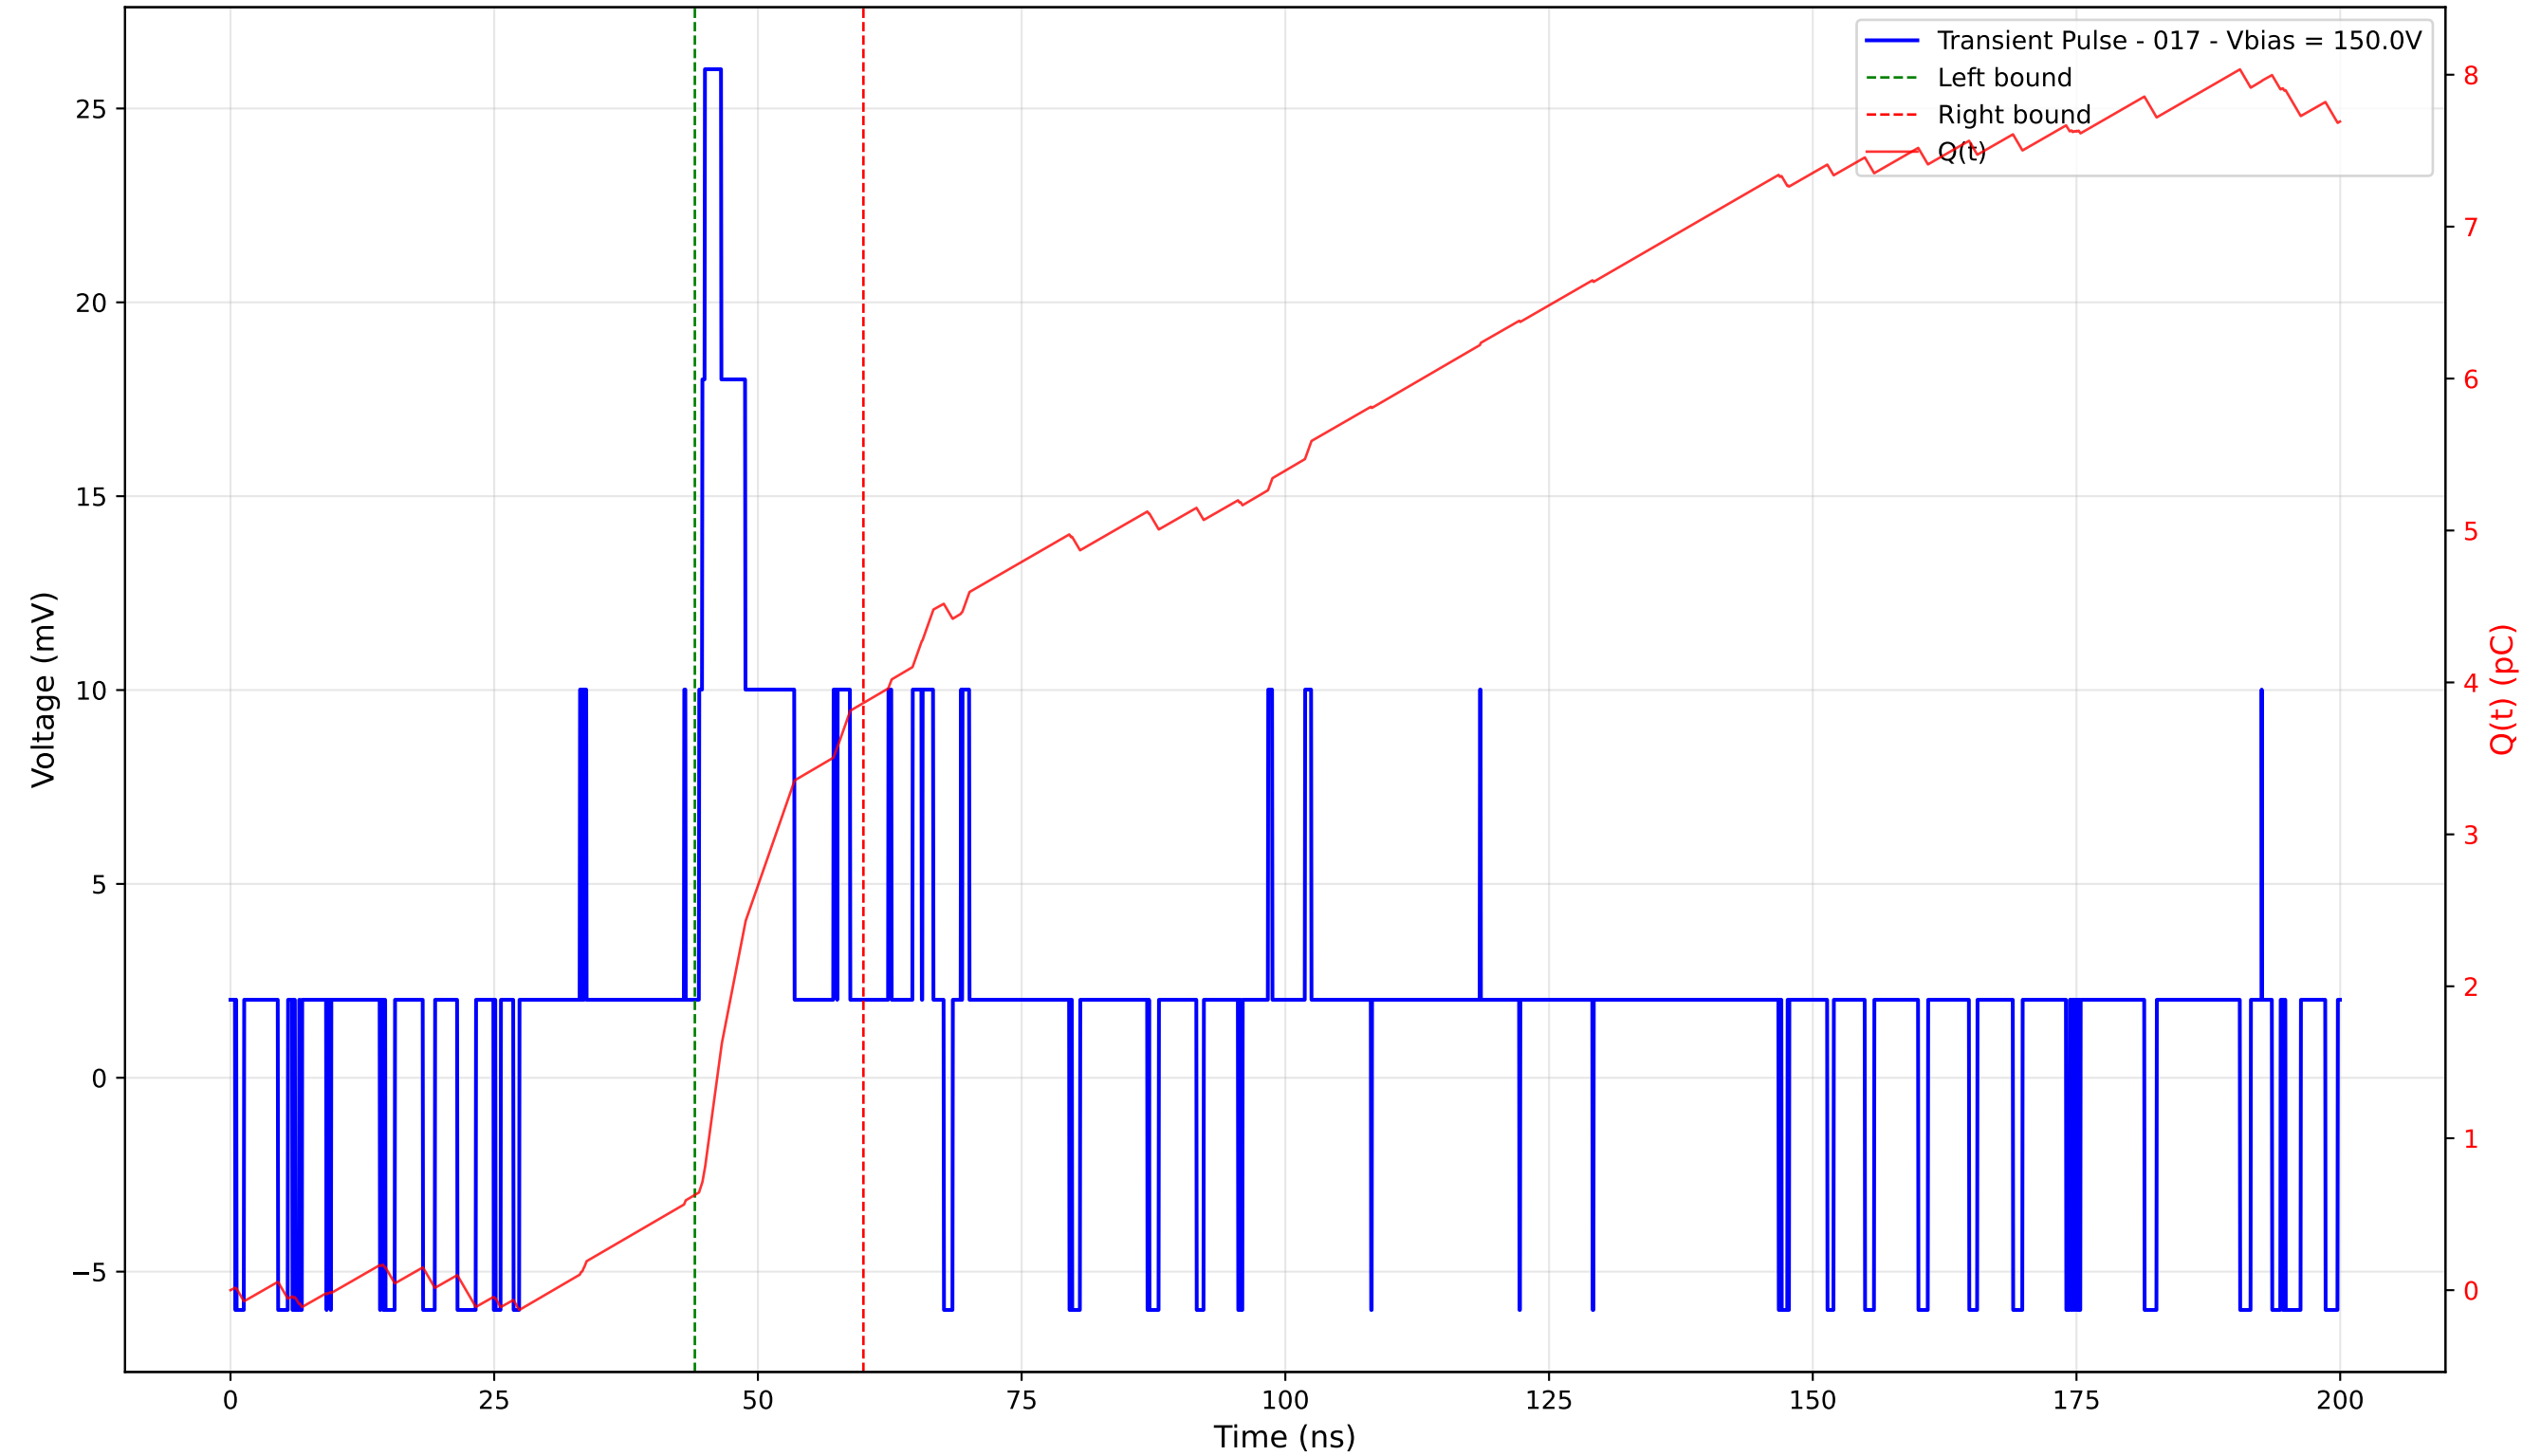


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 3.15 pC - Rise Time: 0.92 ns

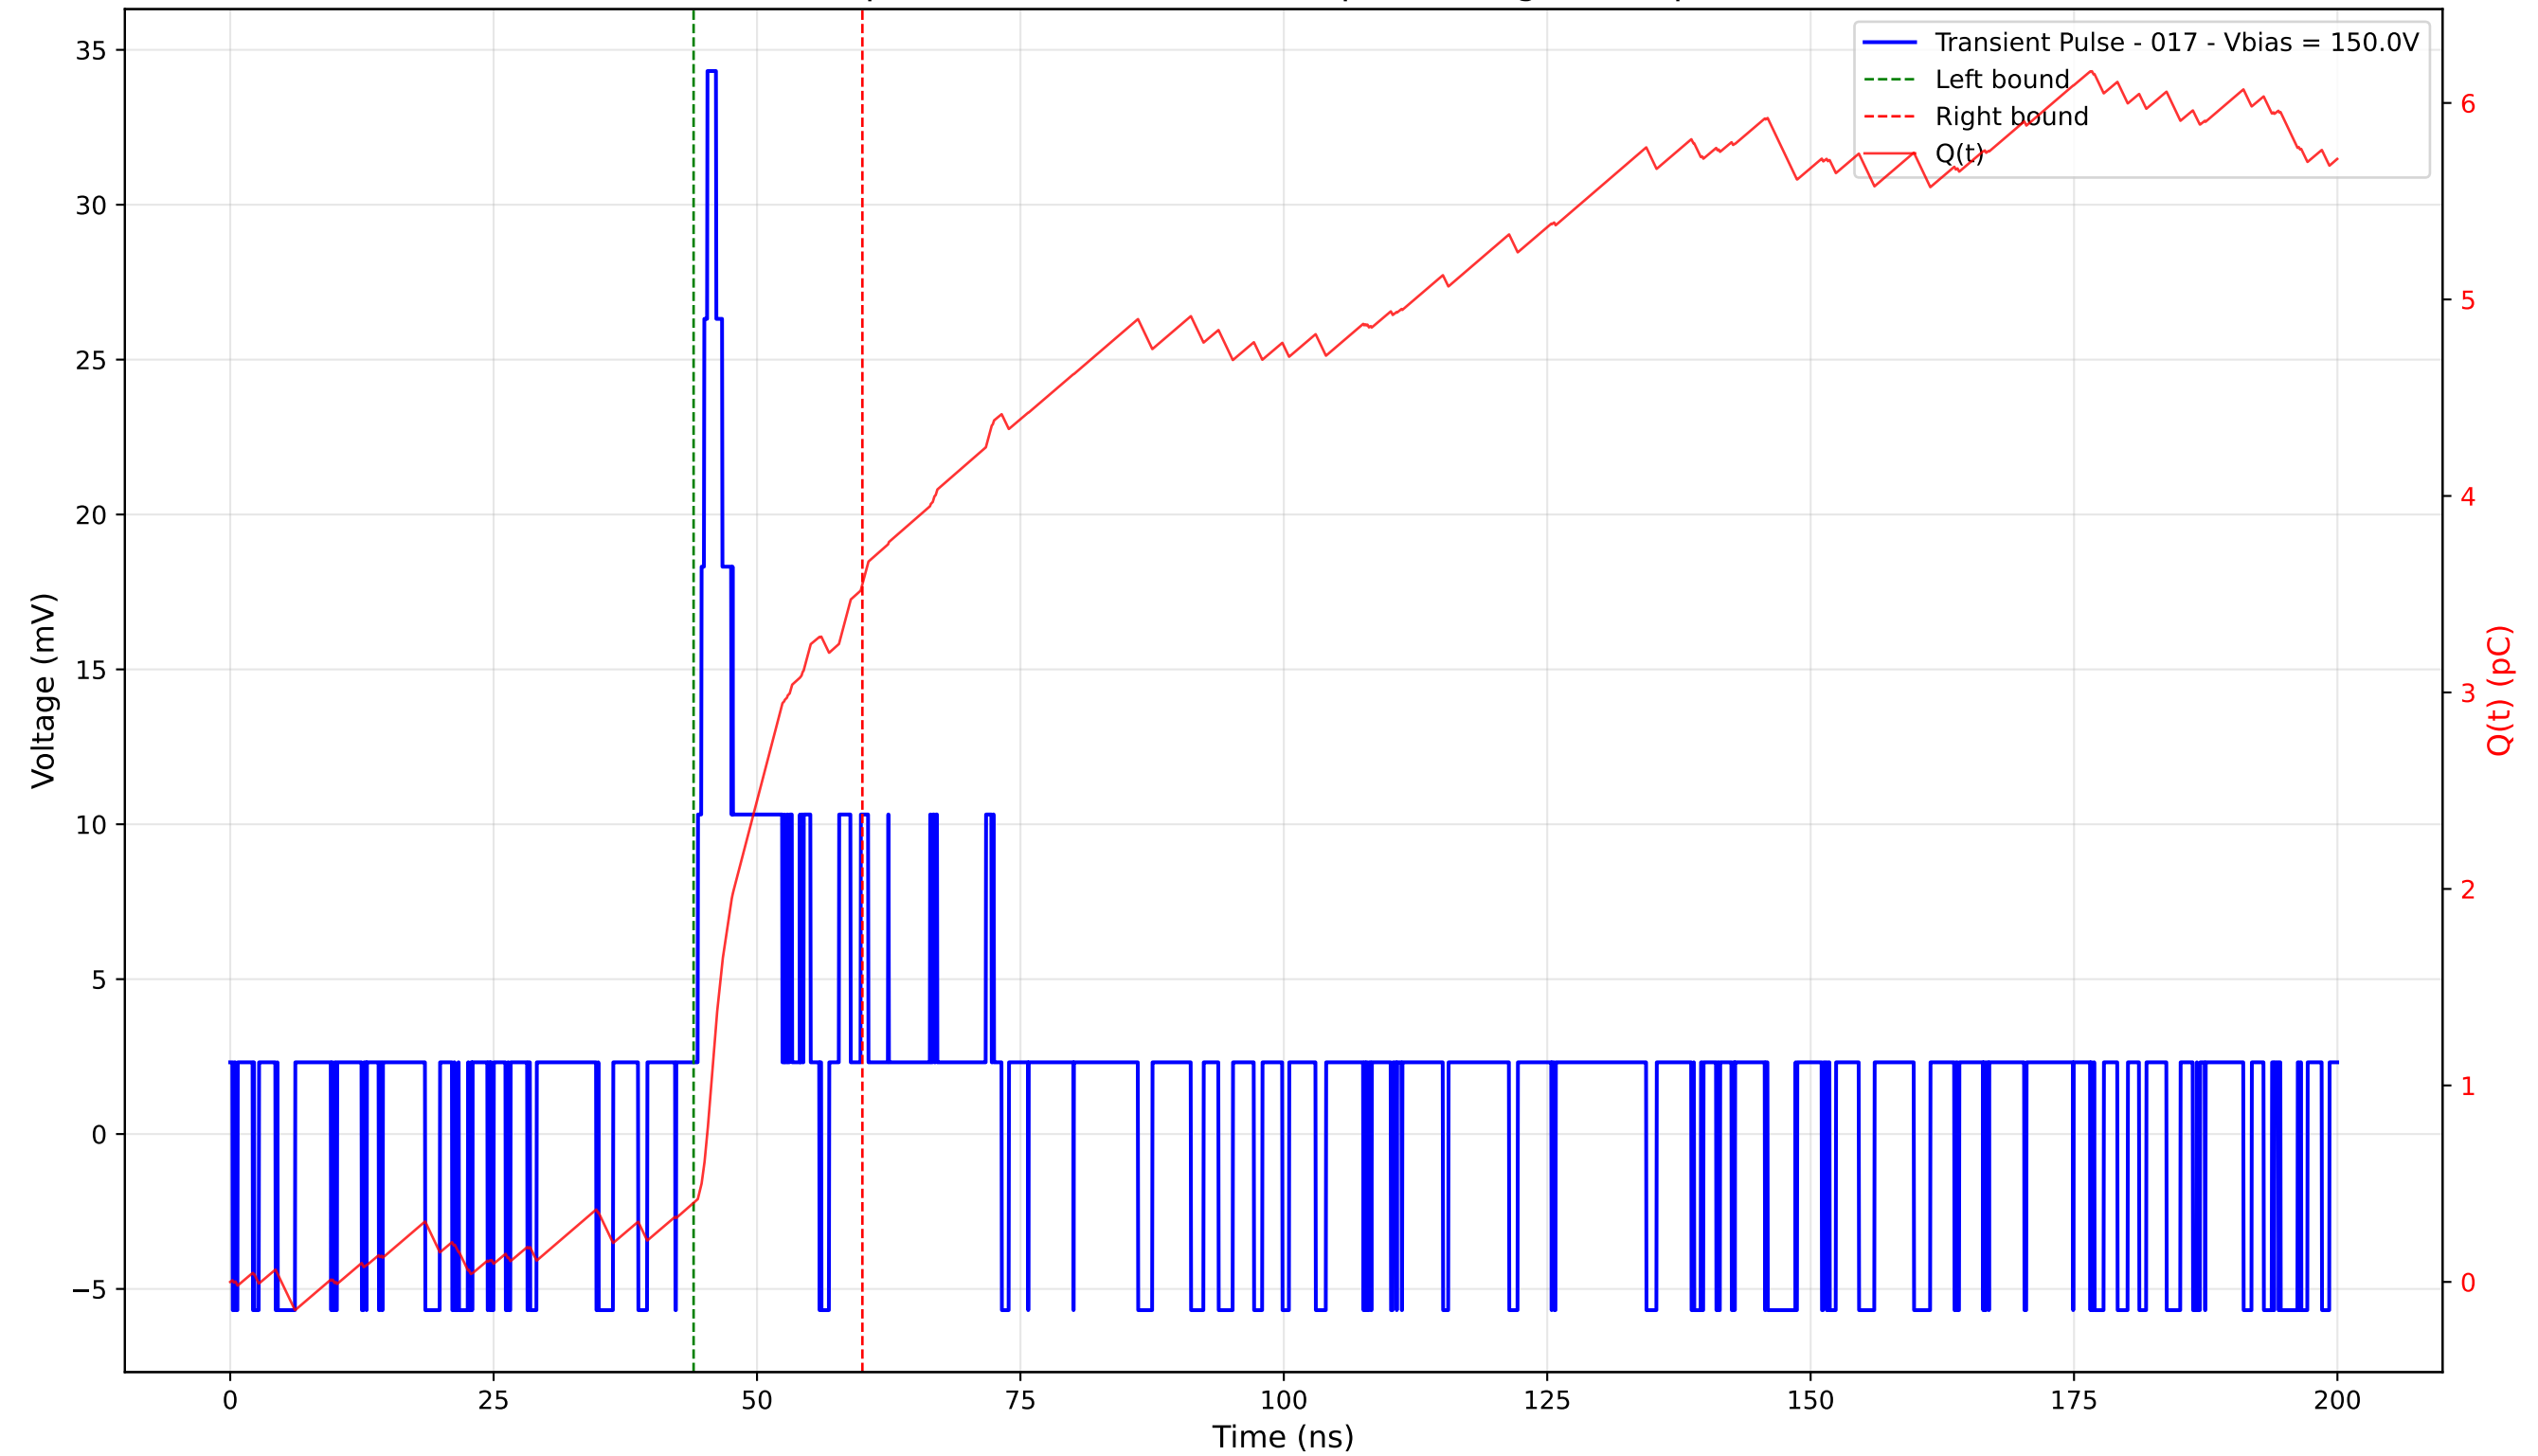


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 3.13 pC - Rise Time: 0.82 ns

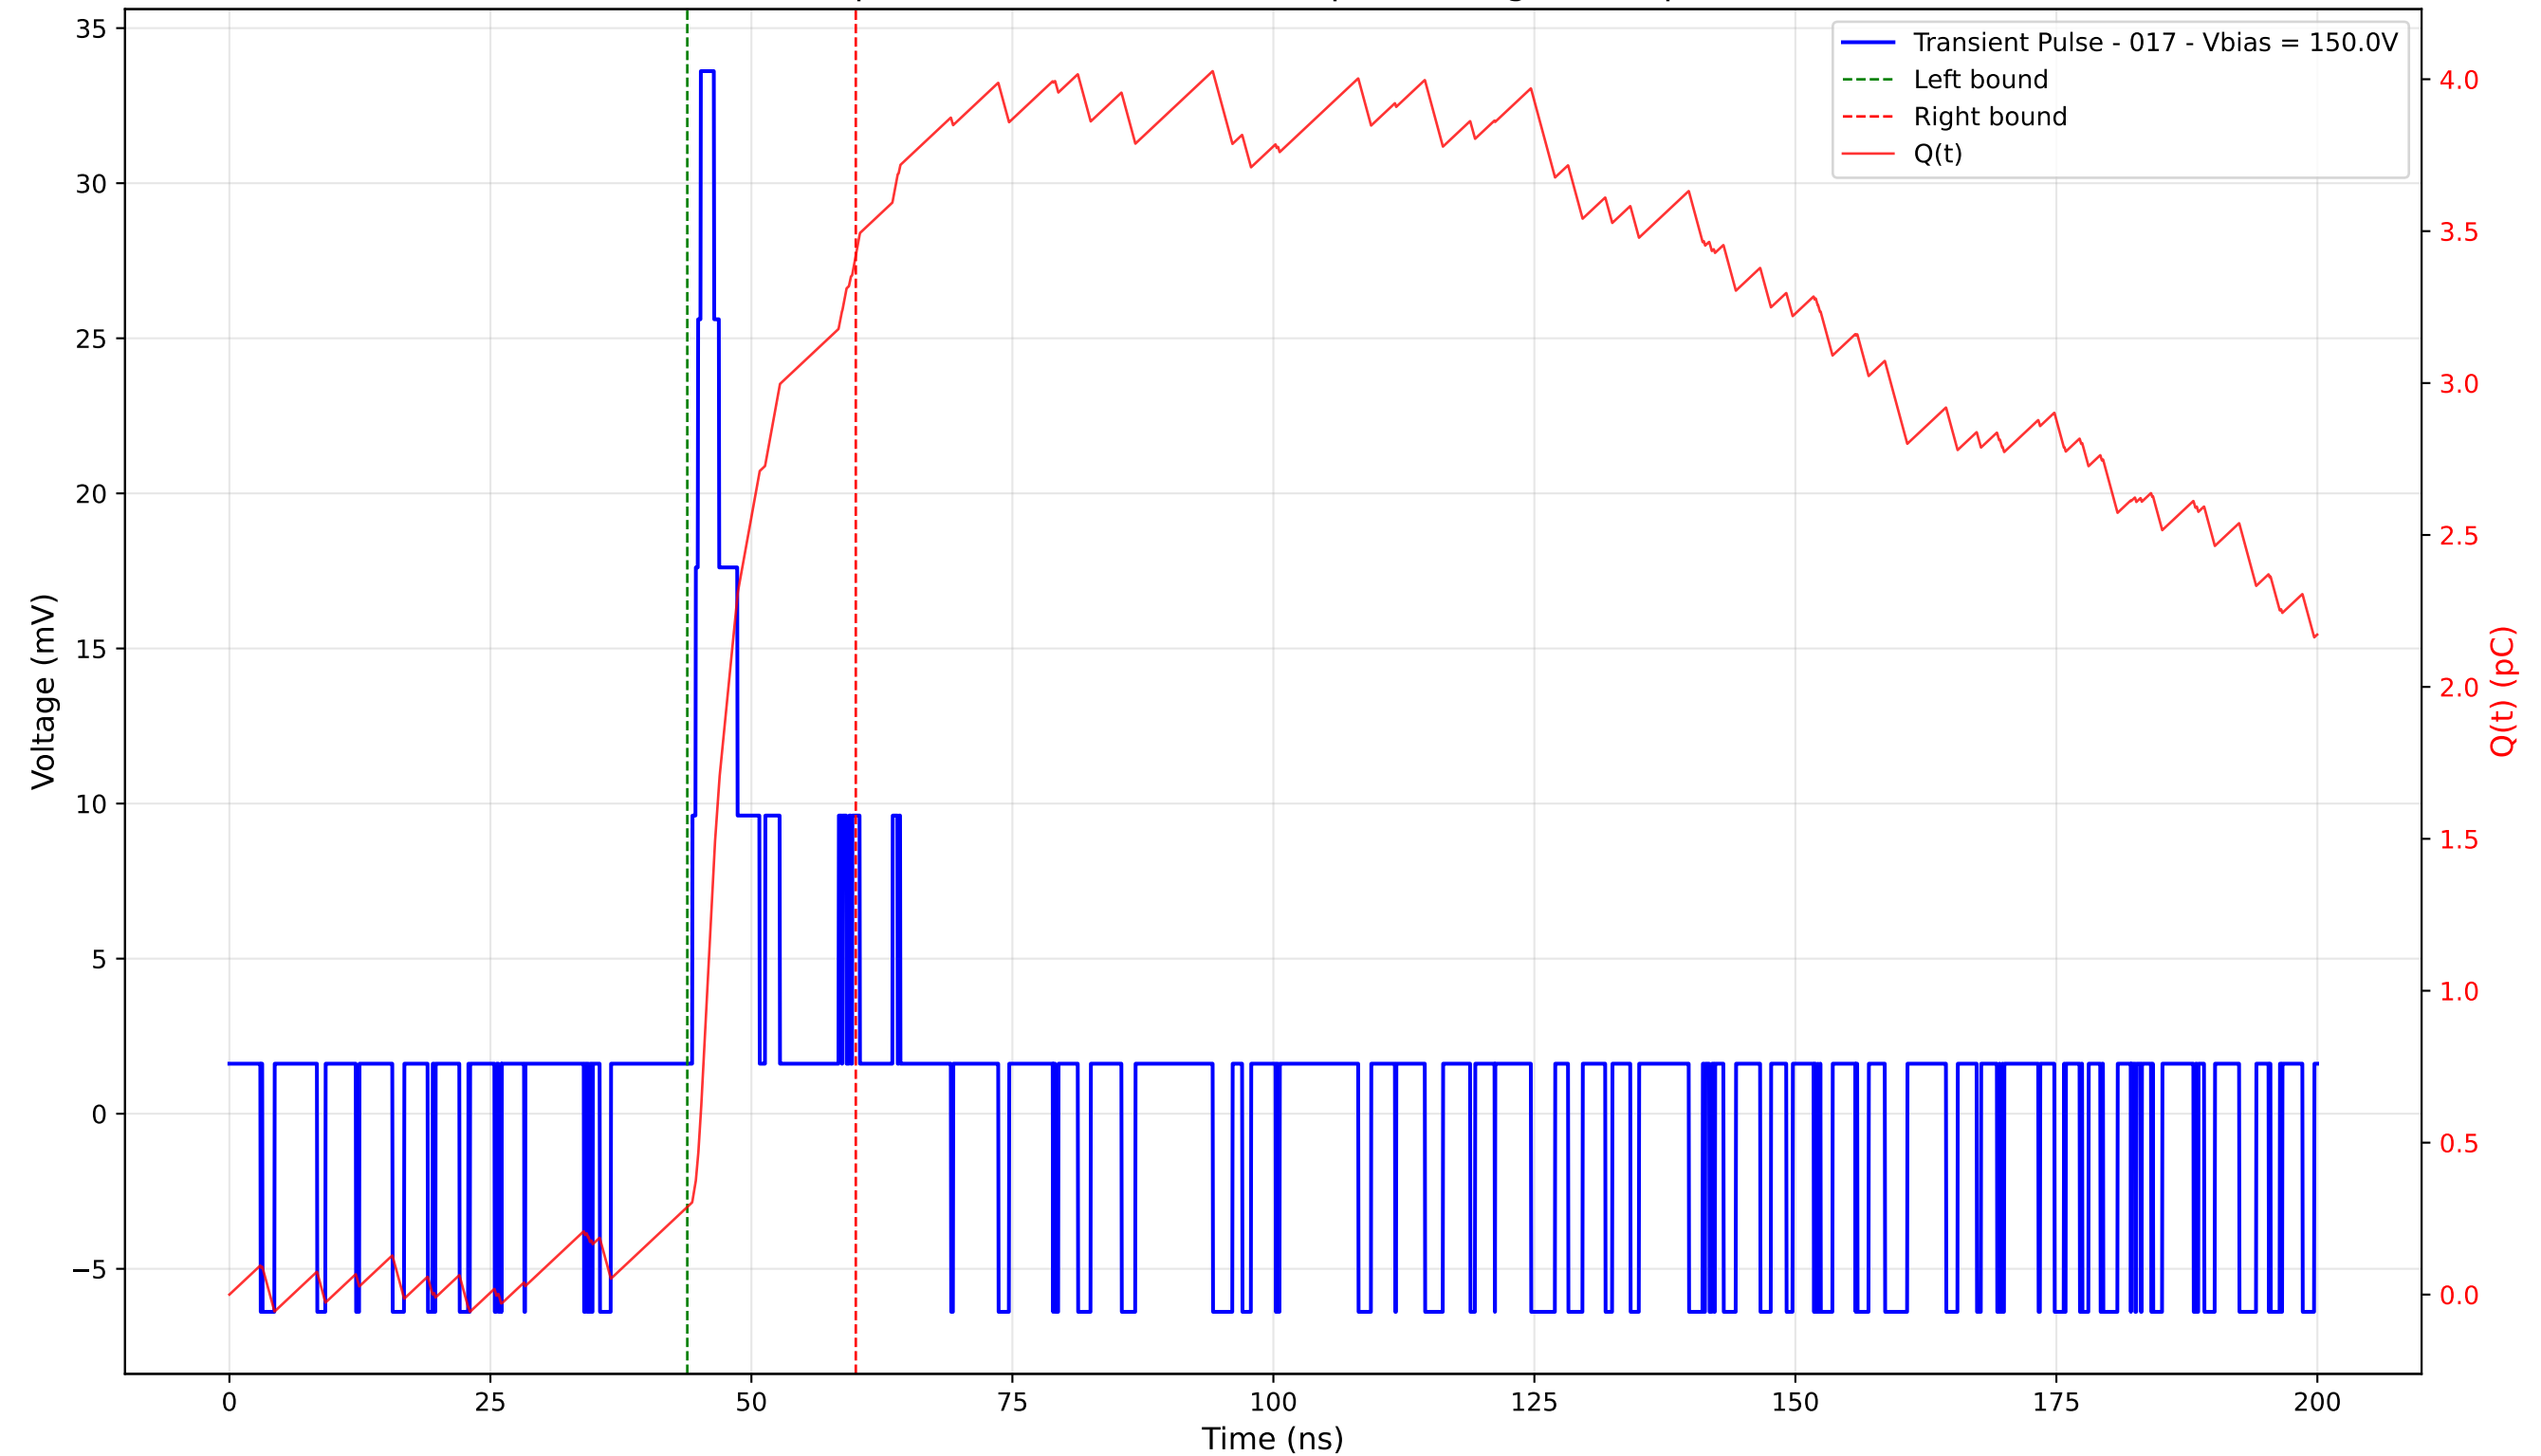


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 3.69 pC - Rise Time: 0.93 ns

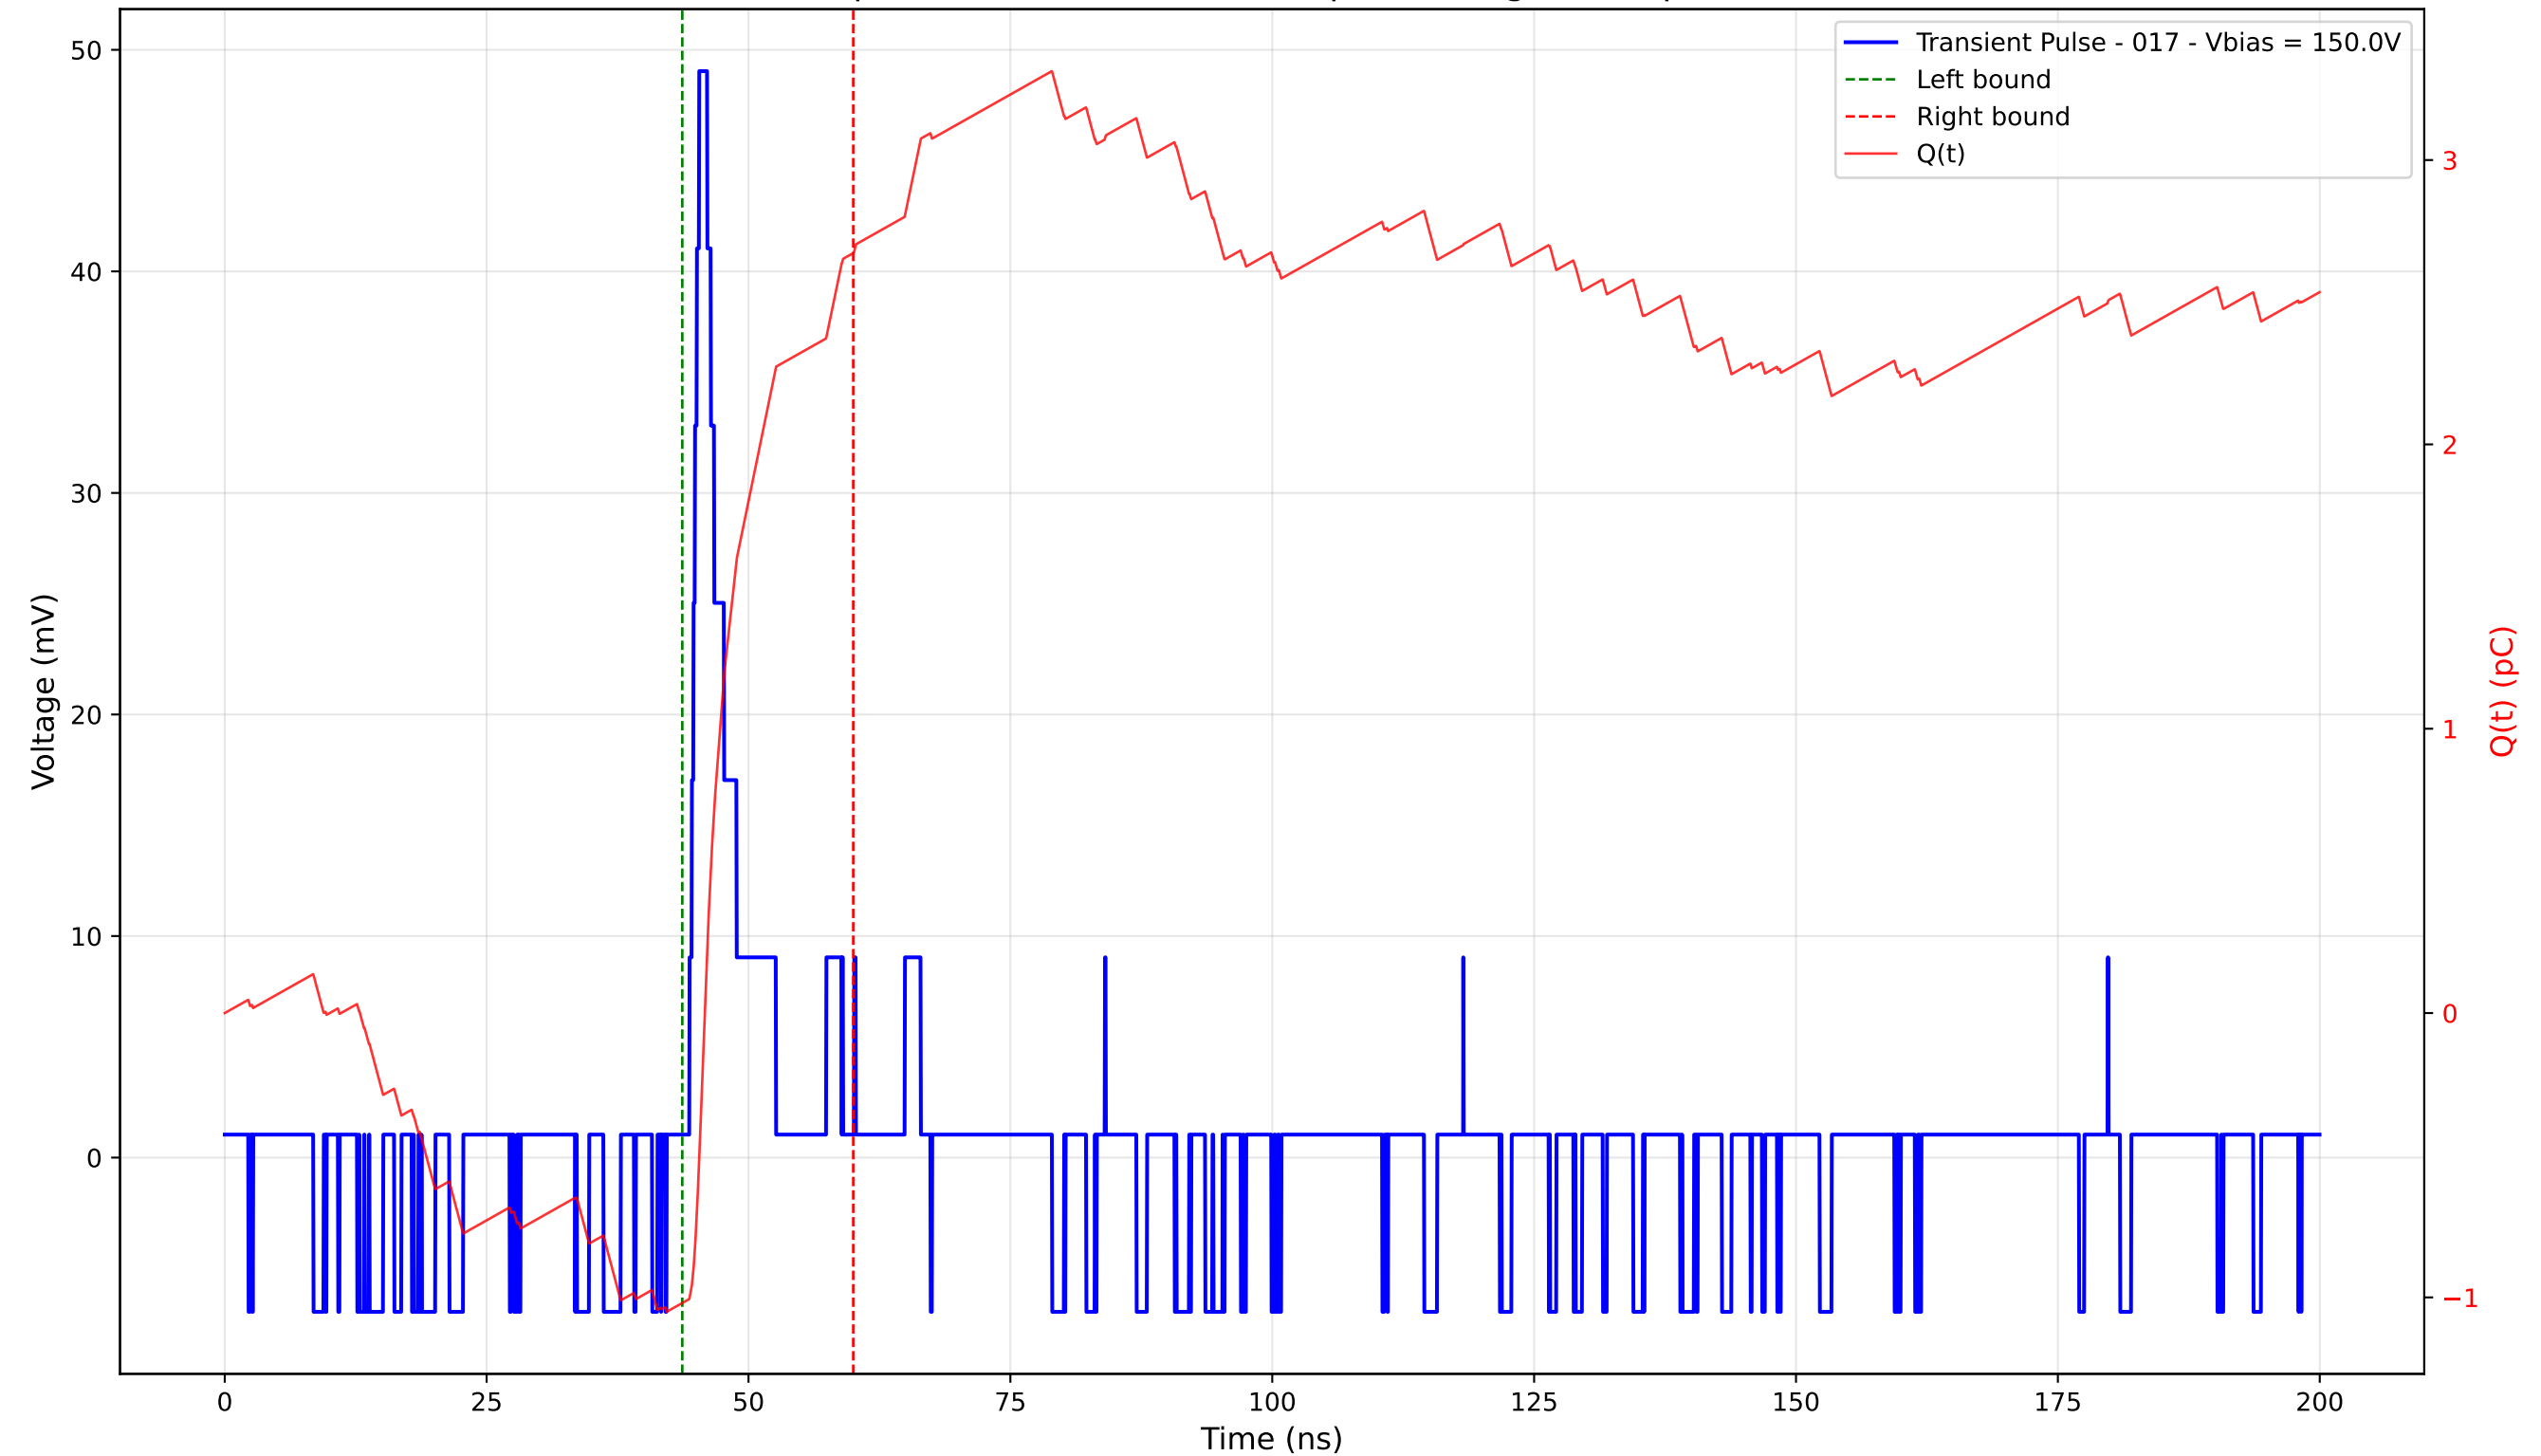


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 4.47 pC - Rise Time: 1.11 ns

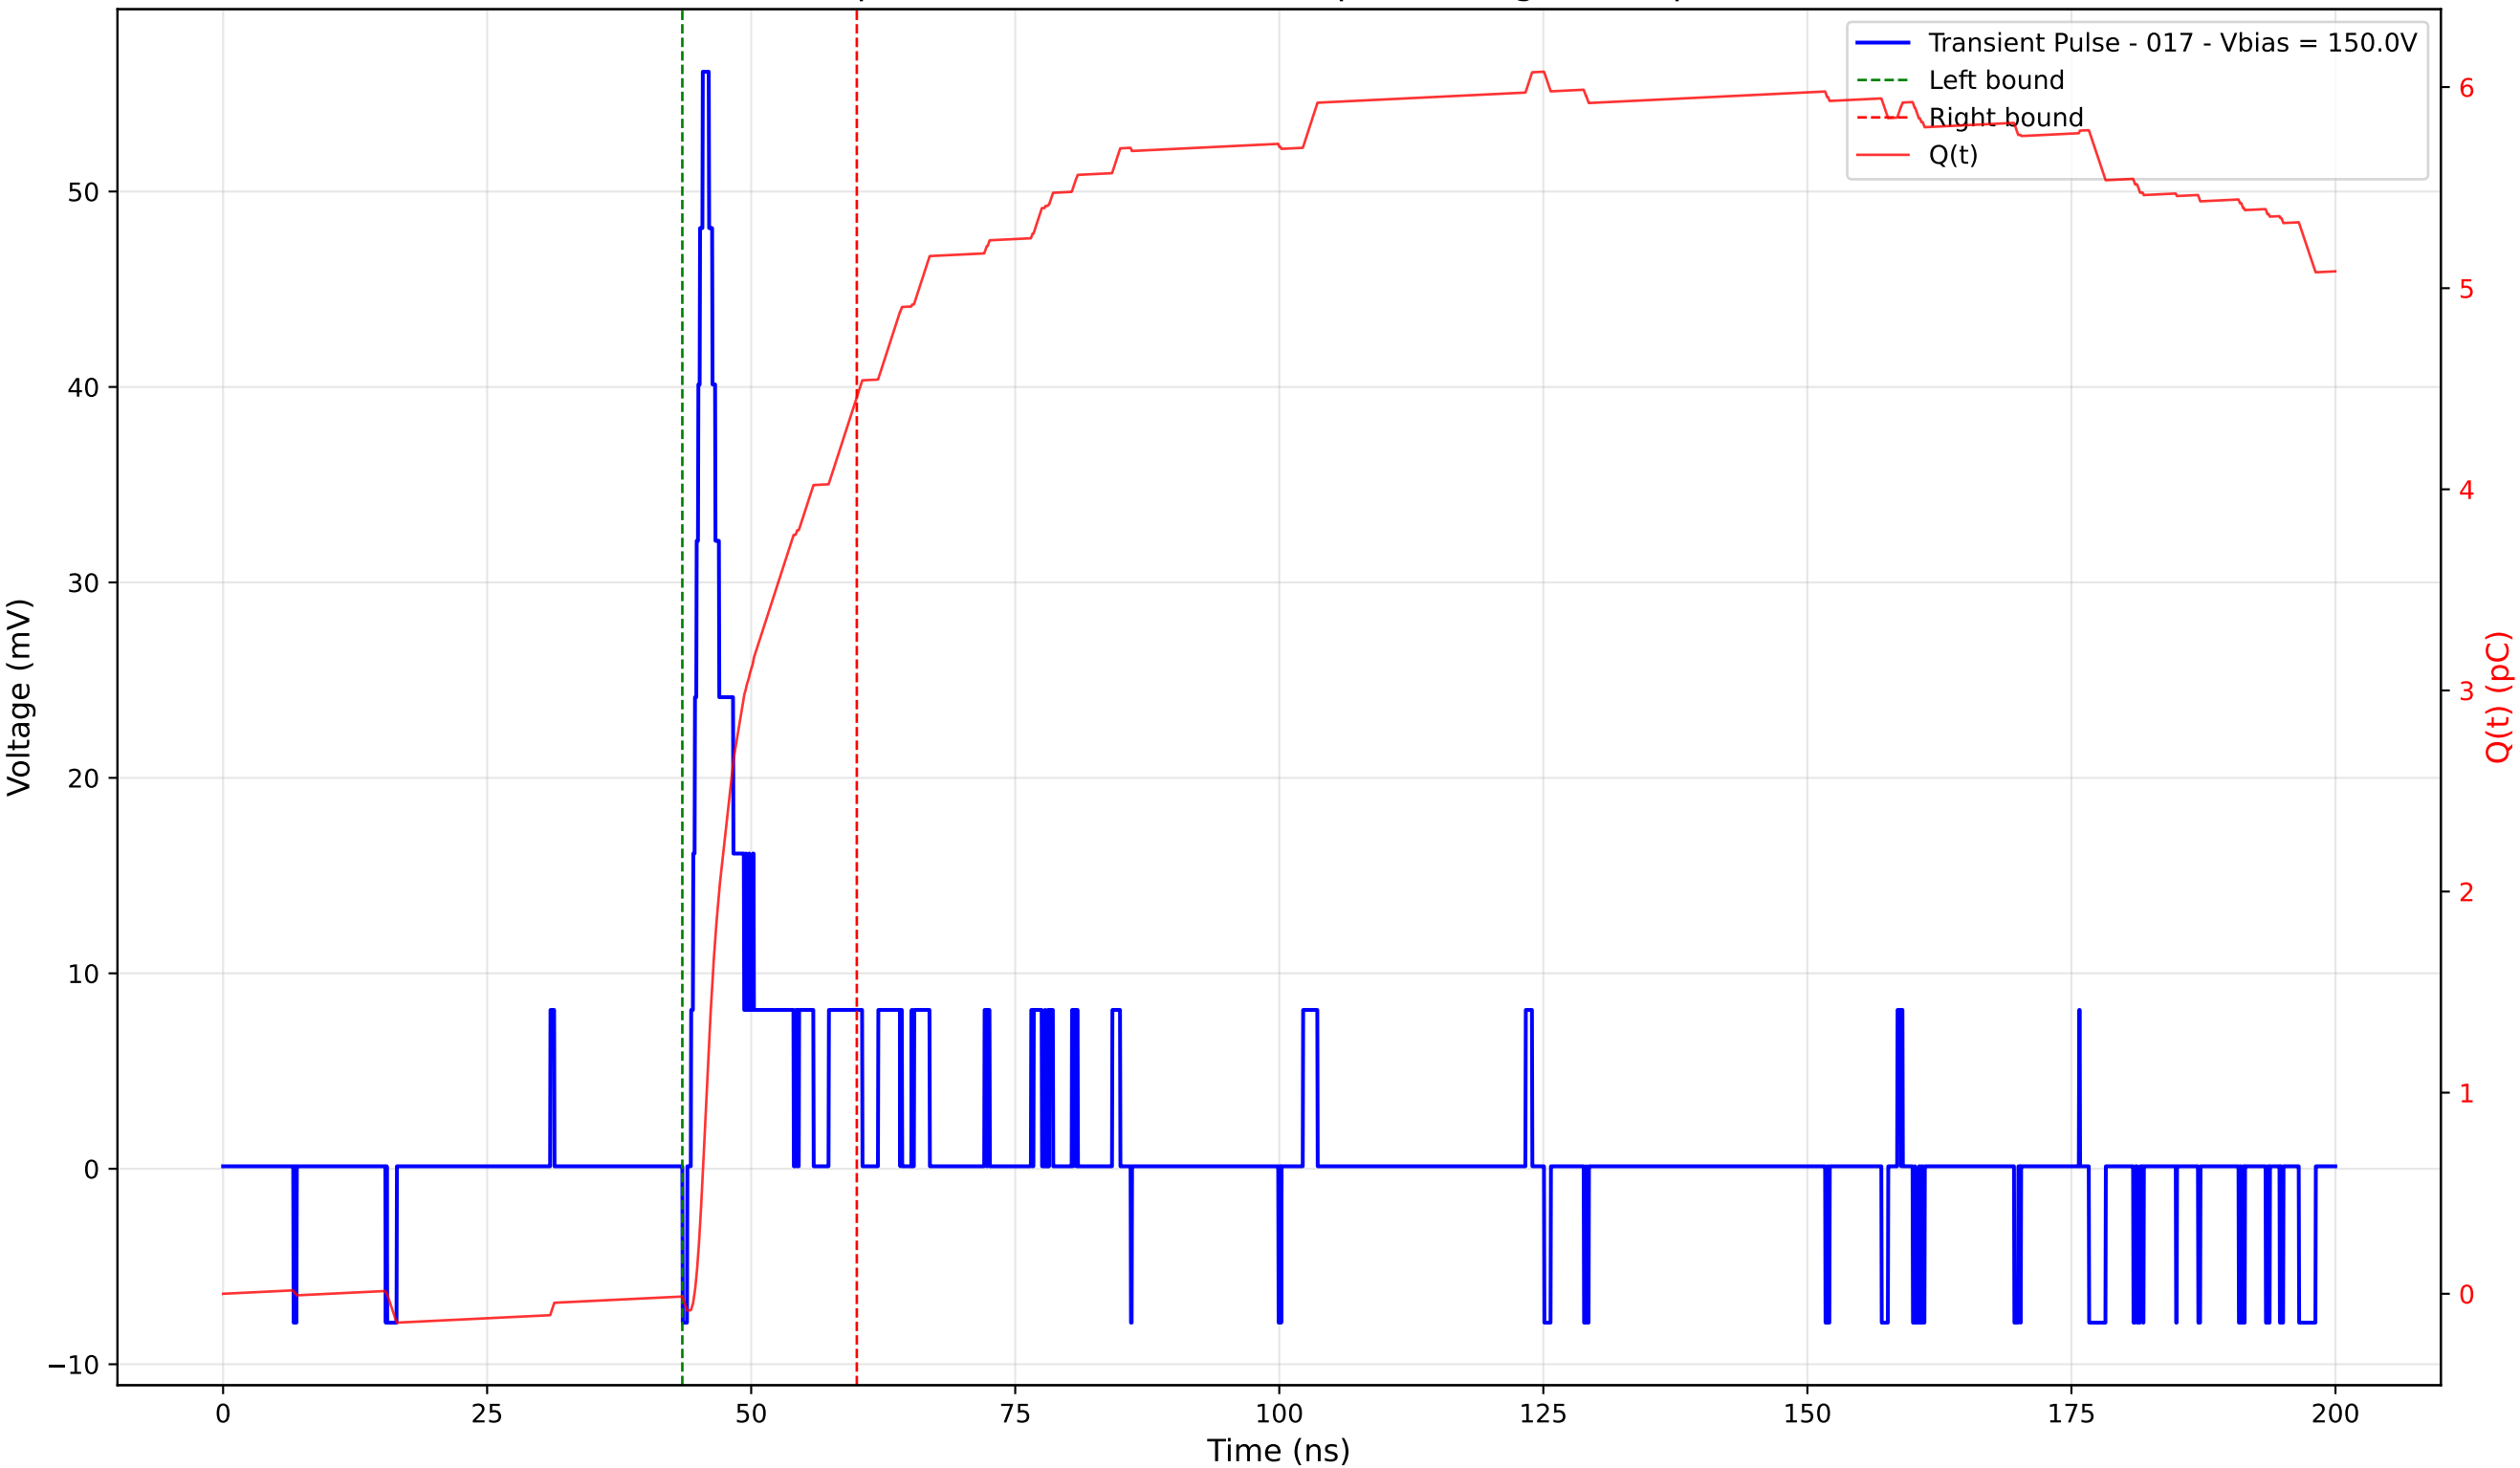


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 4.67 pC - Rise Time: 0.98 ns

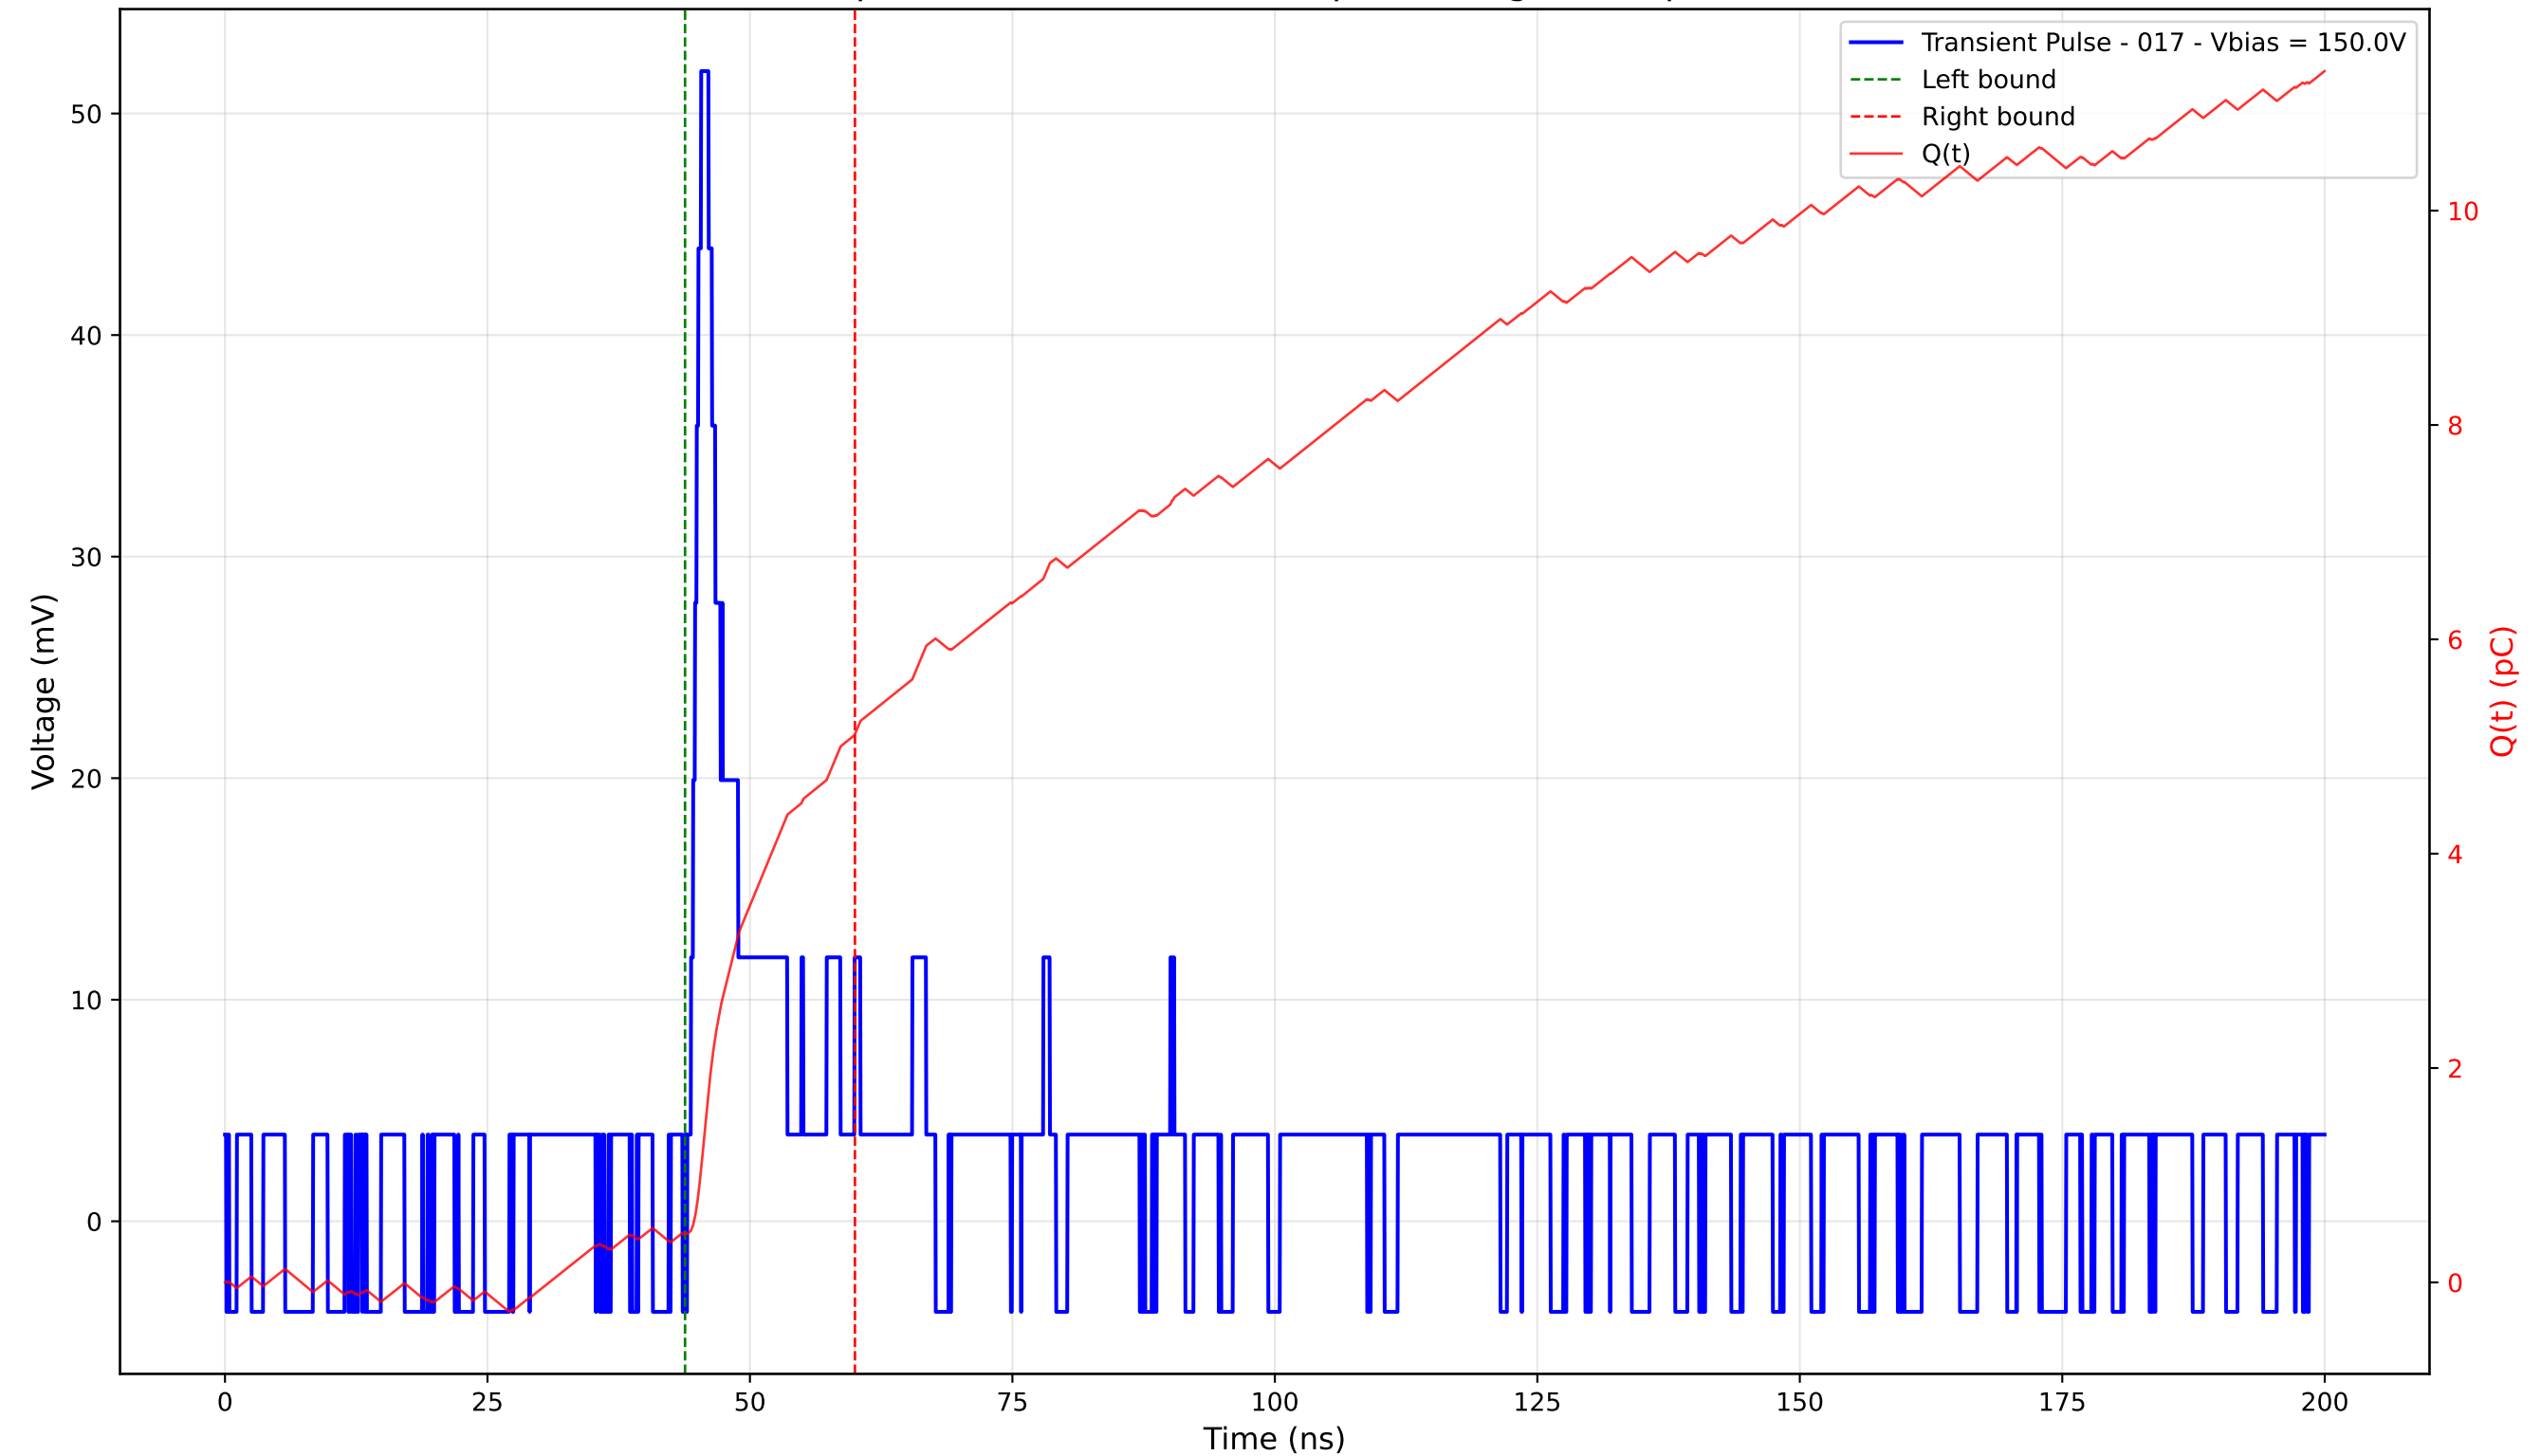


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 3.89 pC - Rise Time: 0.82 ns

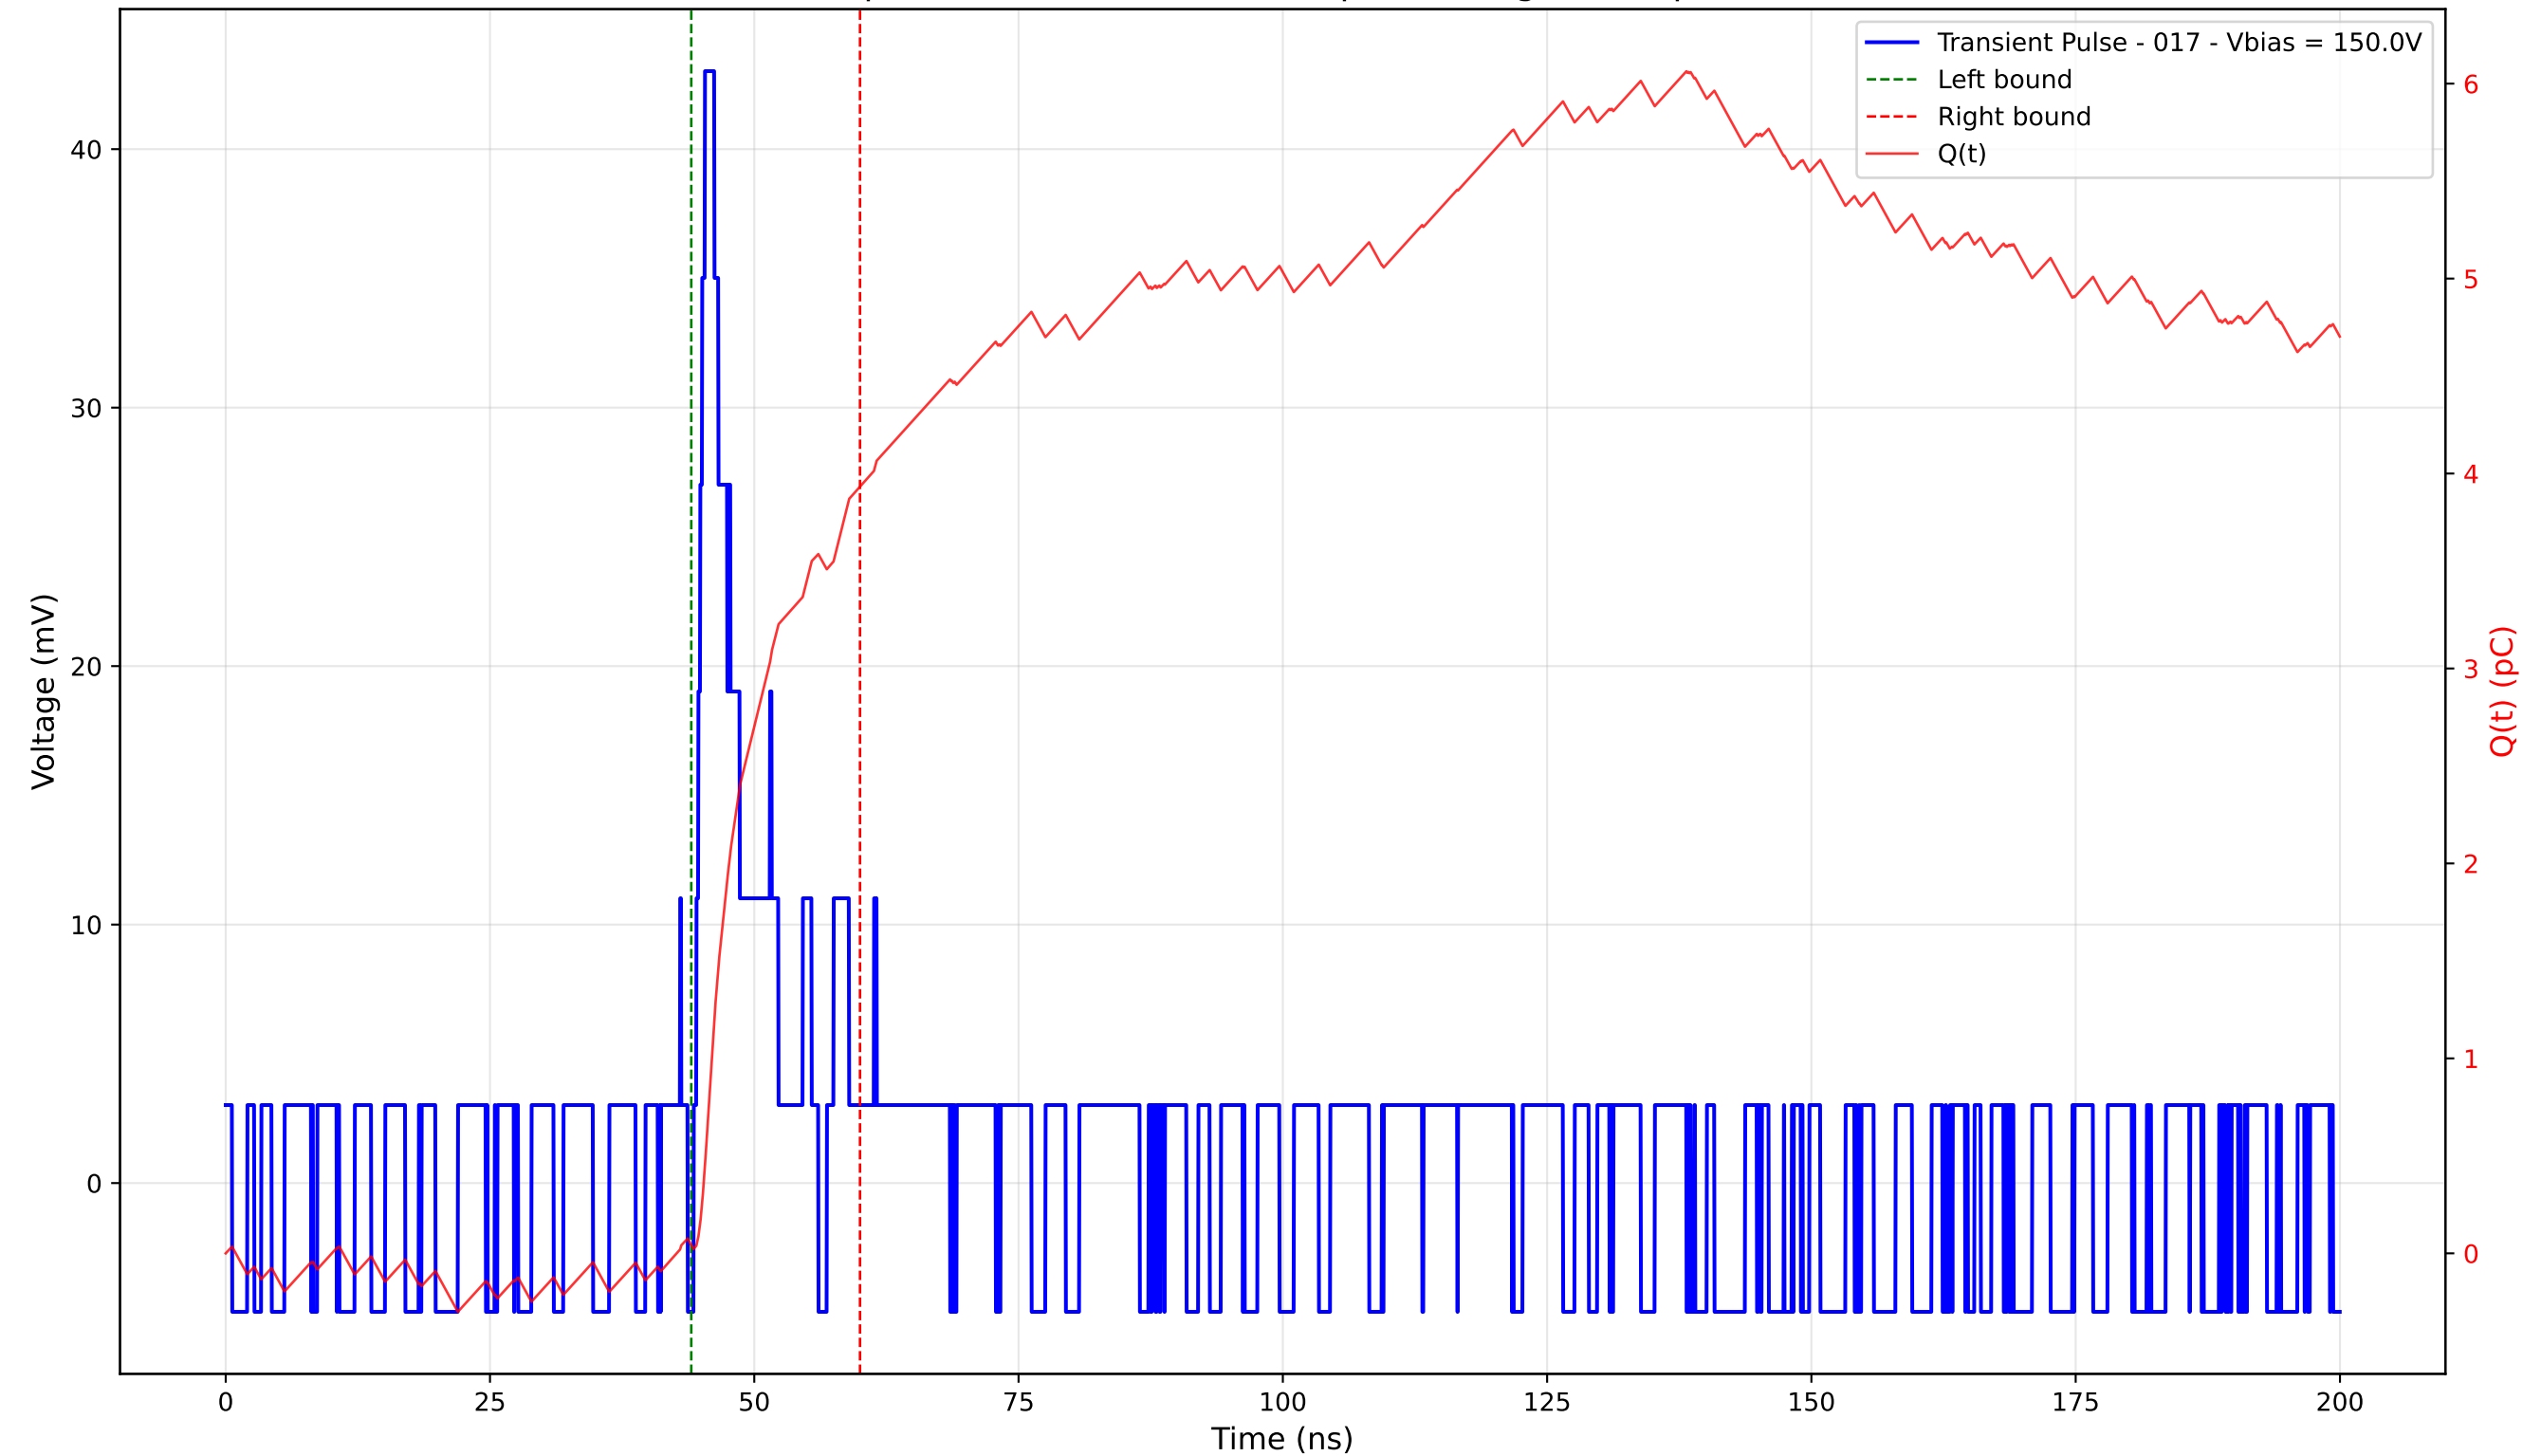


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 3.58 pC - Rise Time: 0.00 ns (N/A)

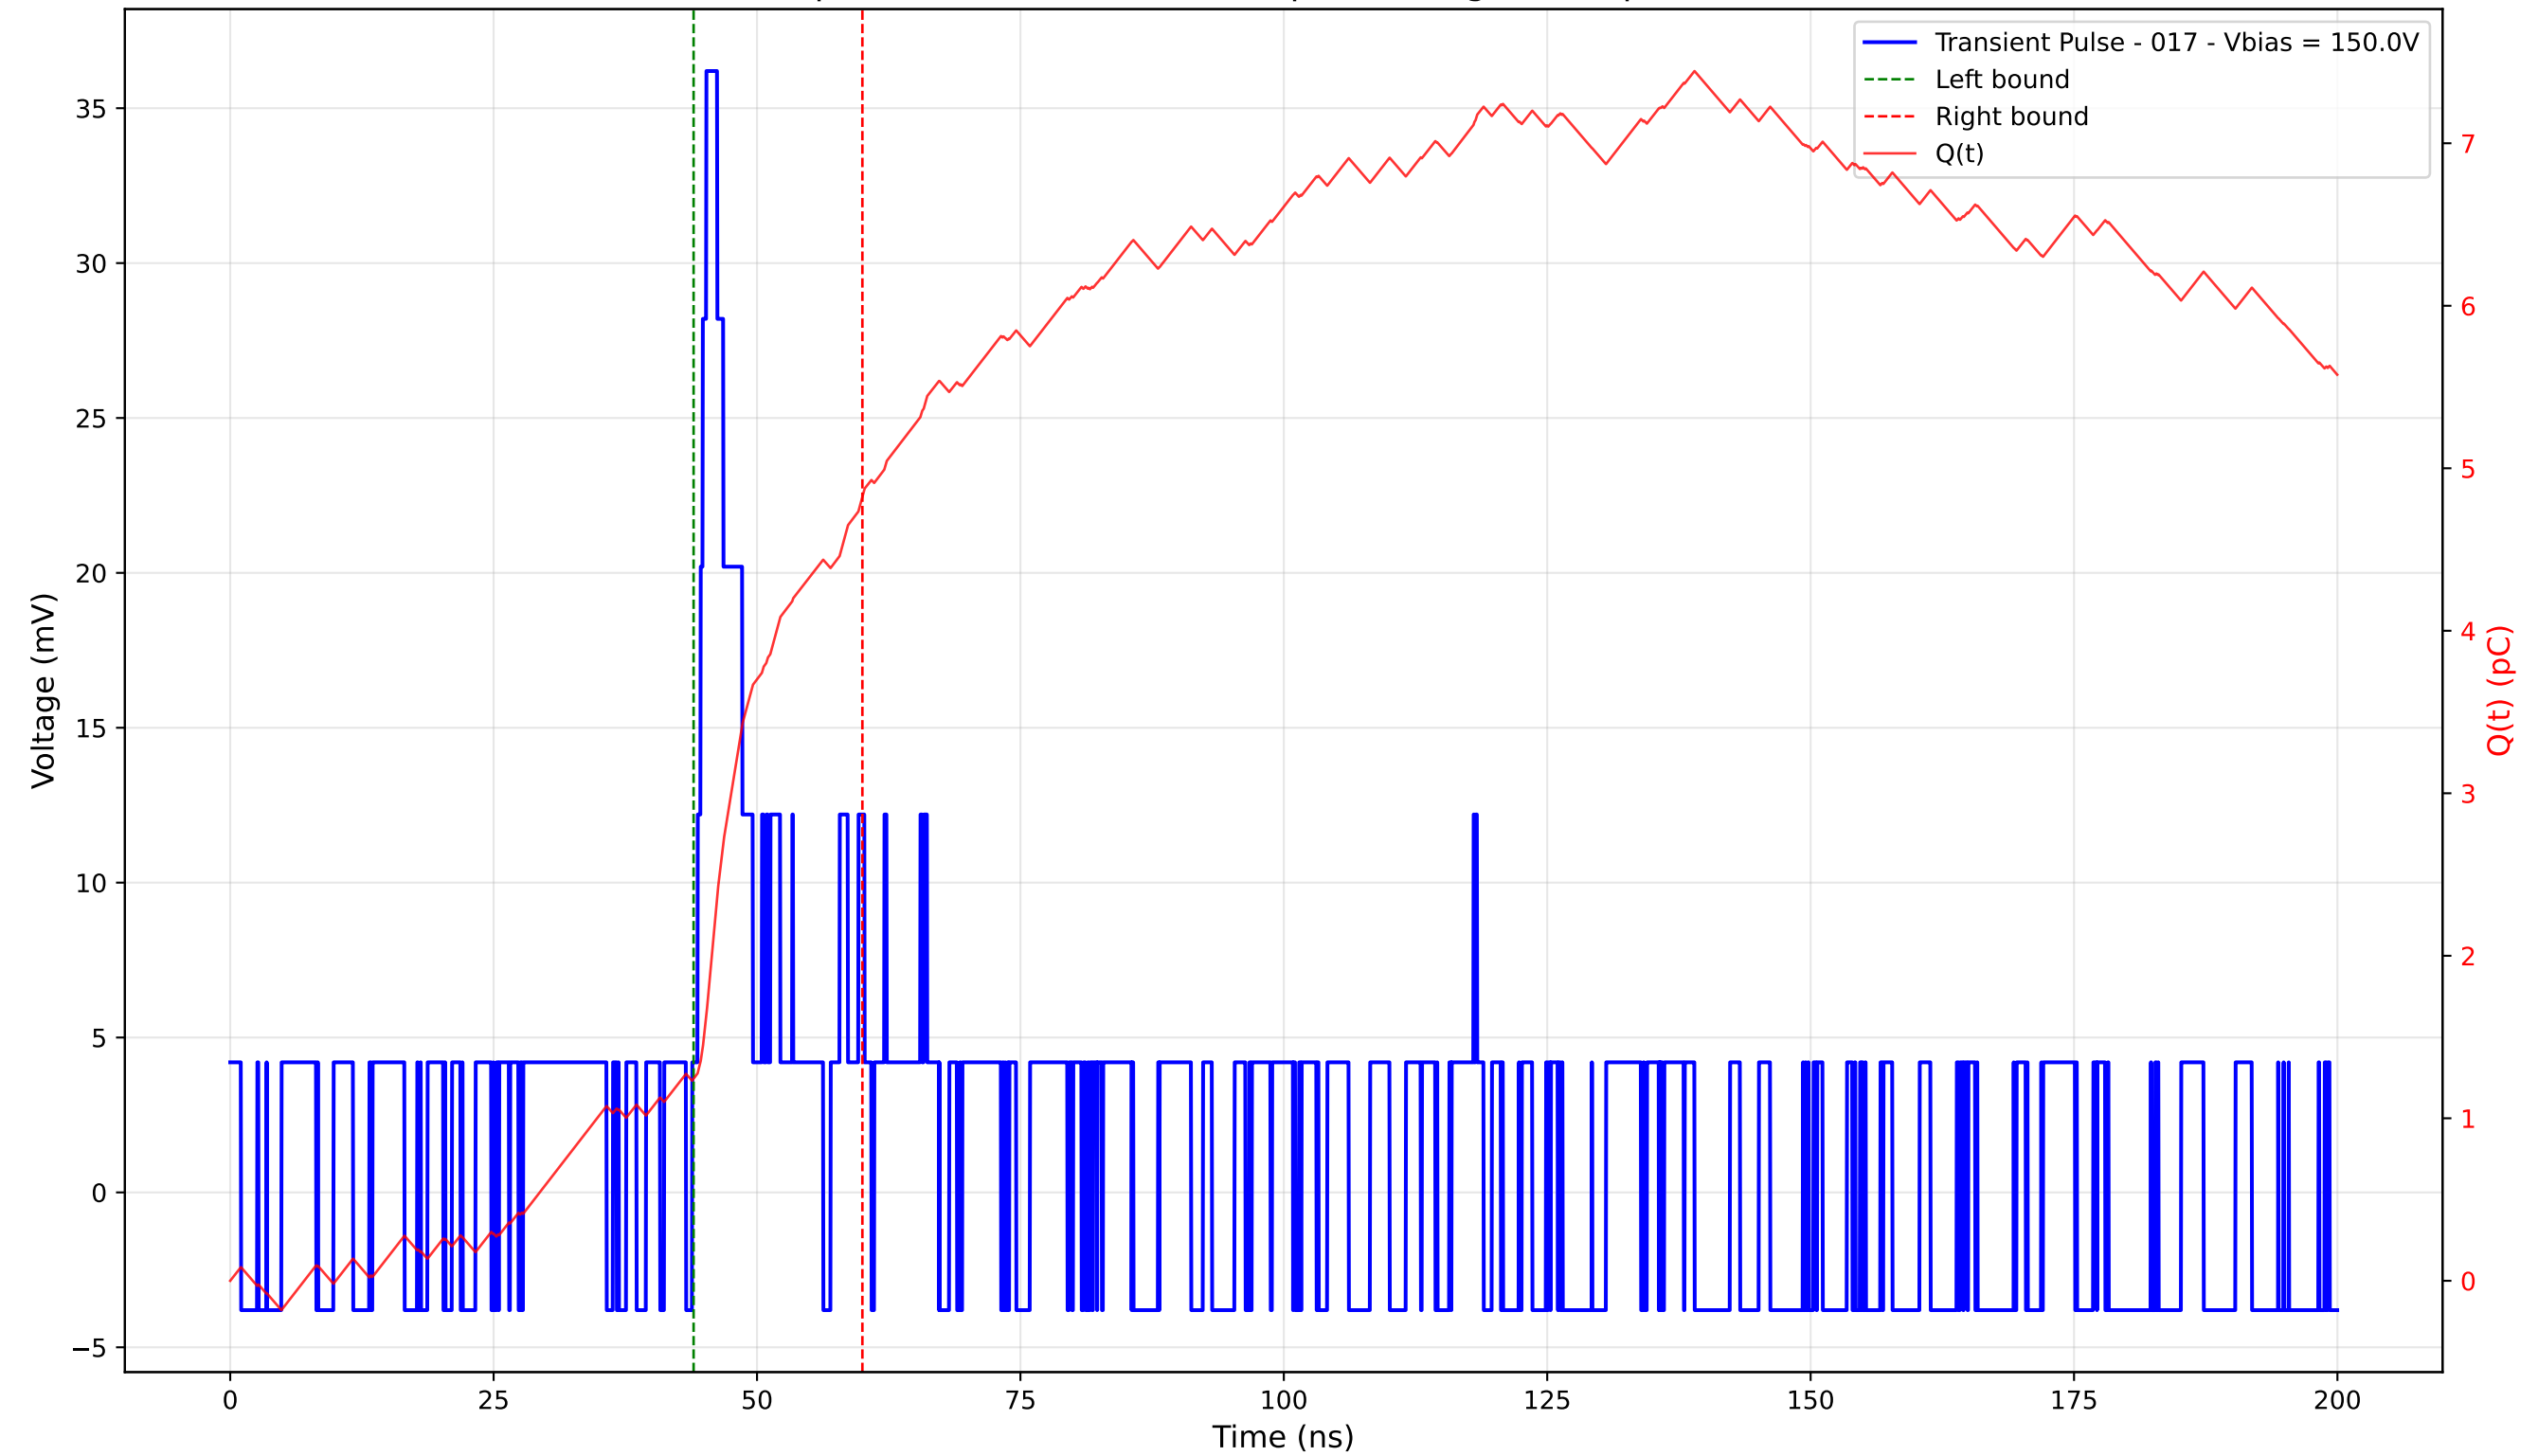

Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 3.97 pC - Rise Time: 3.09 ns

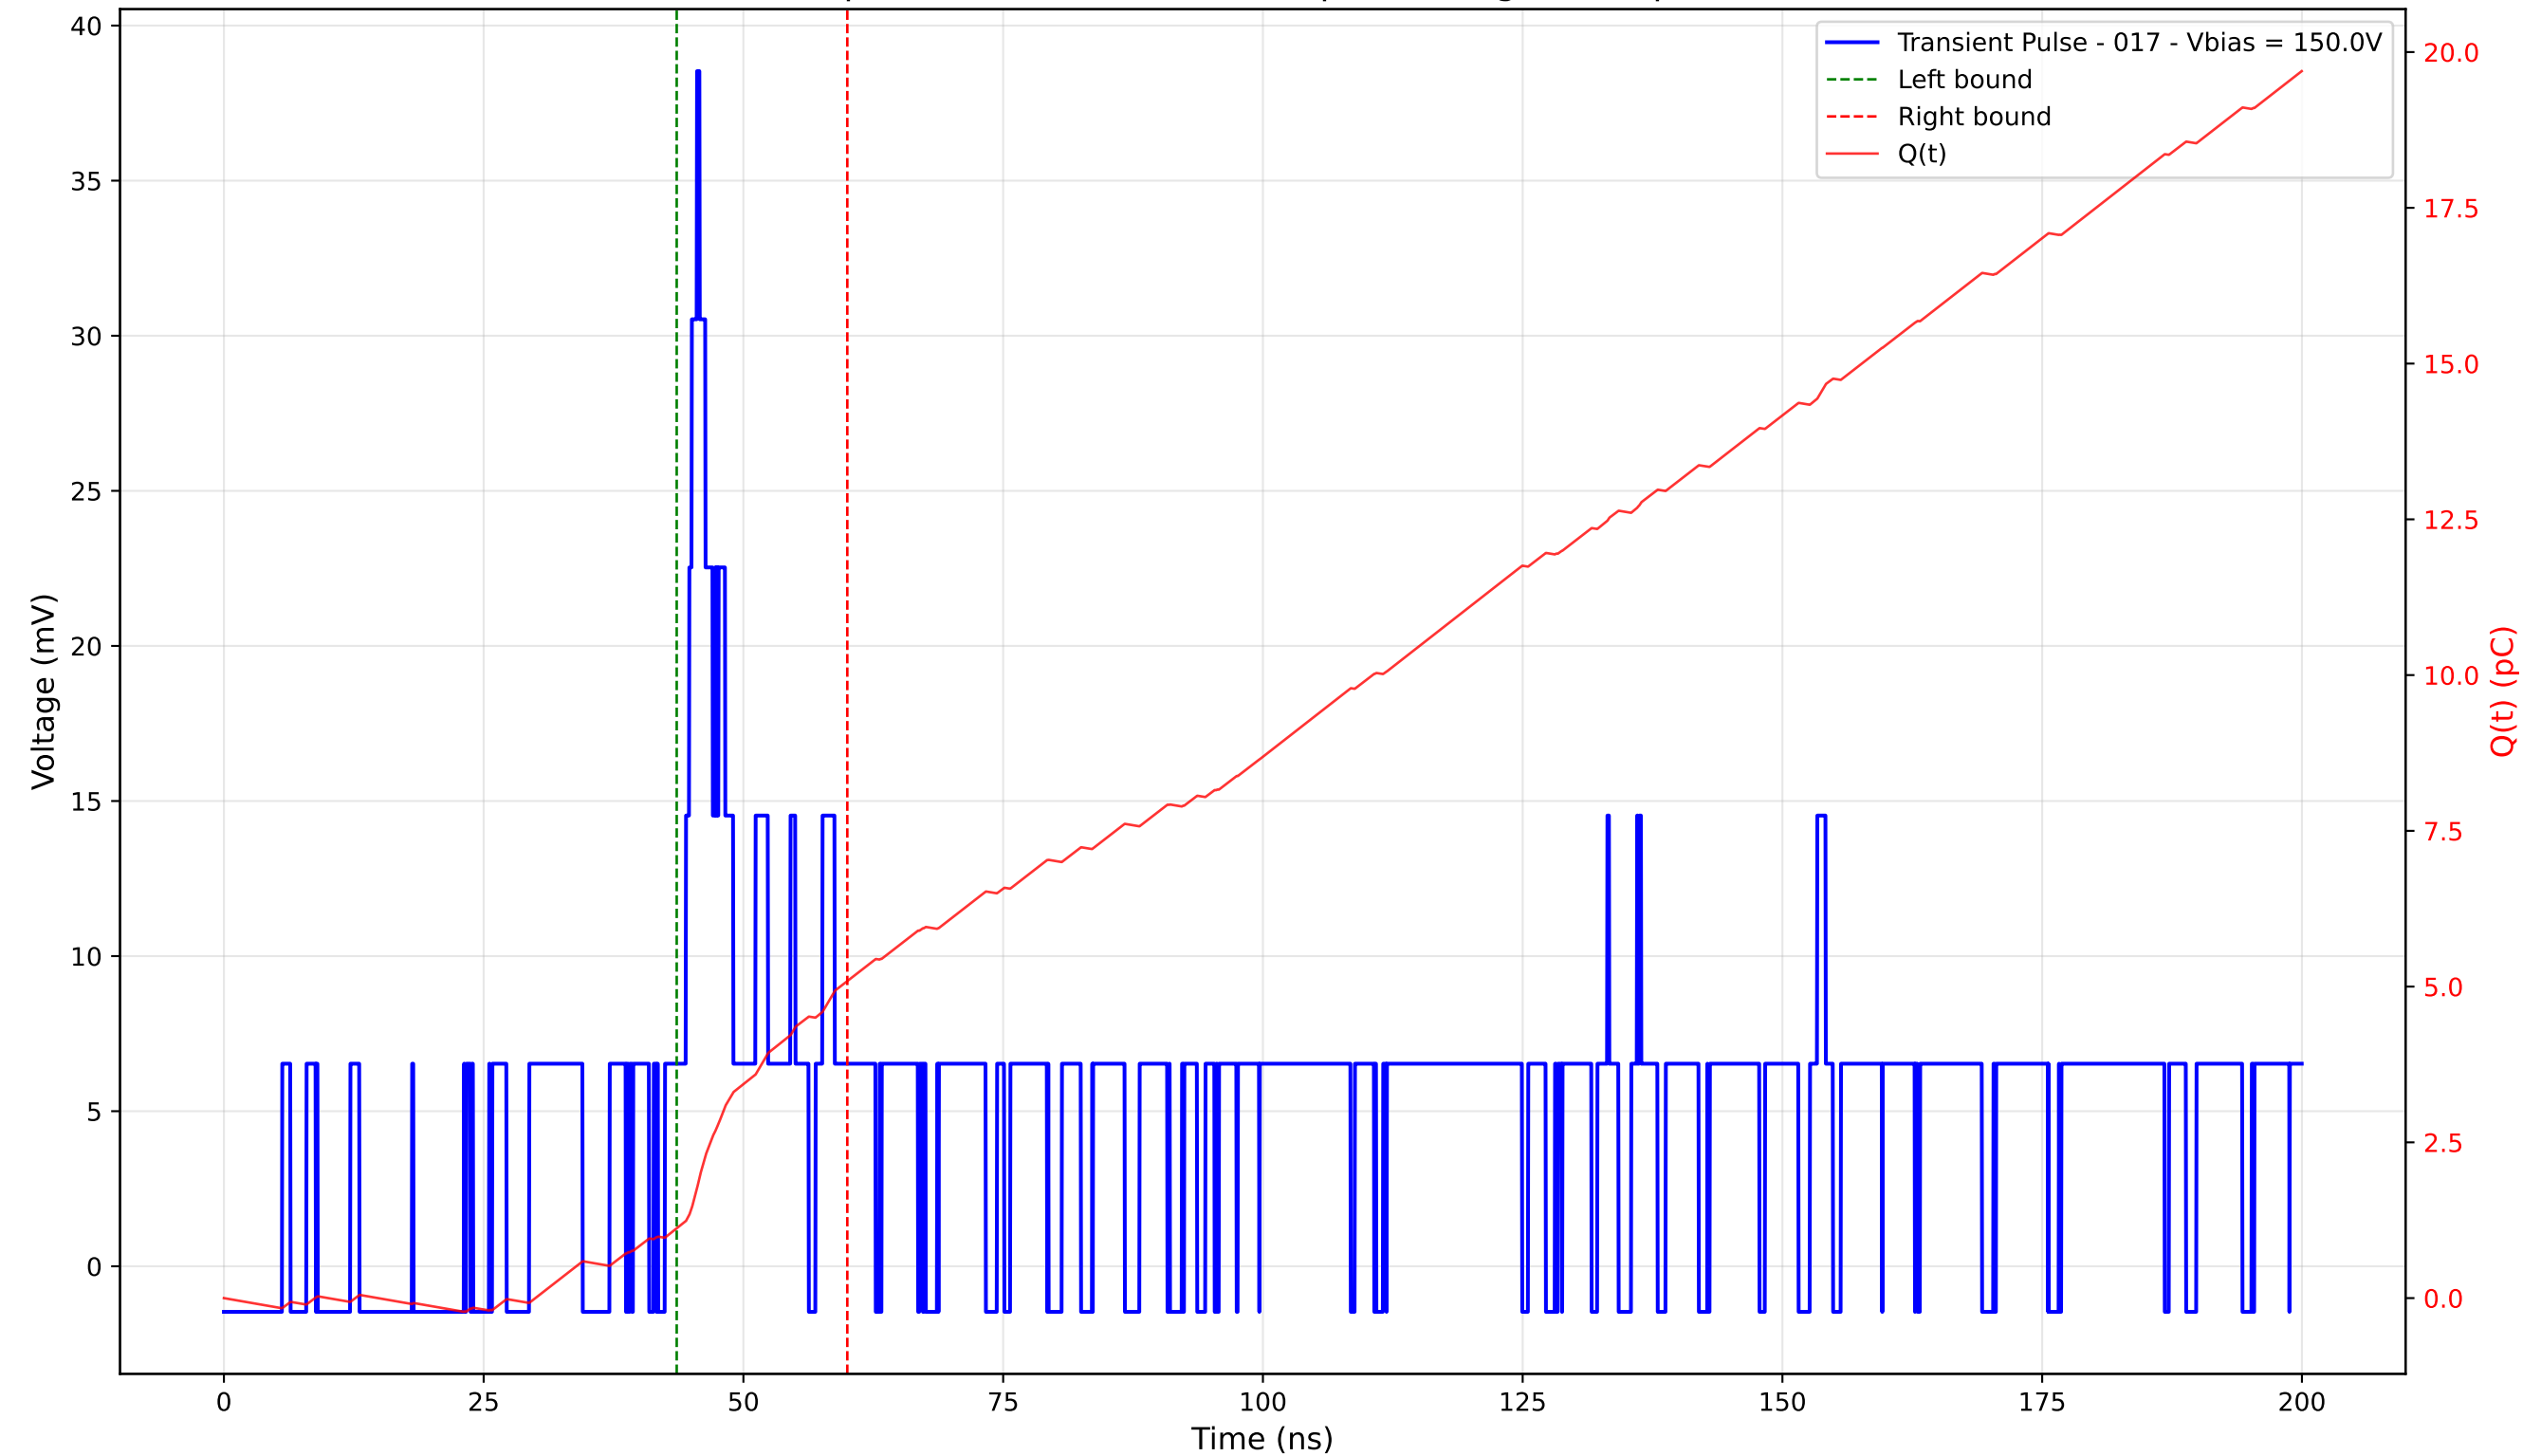

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.23 pC - Rise Time: 0.00 ns (N/A)

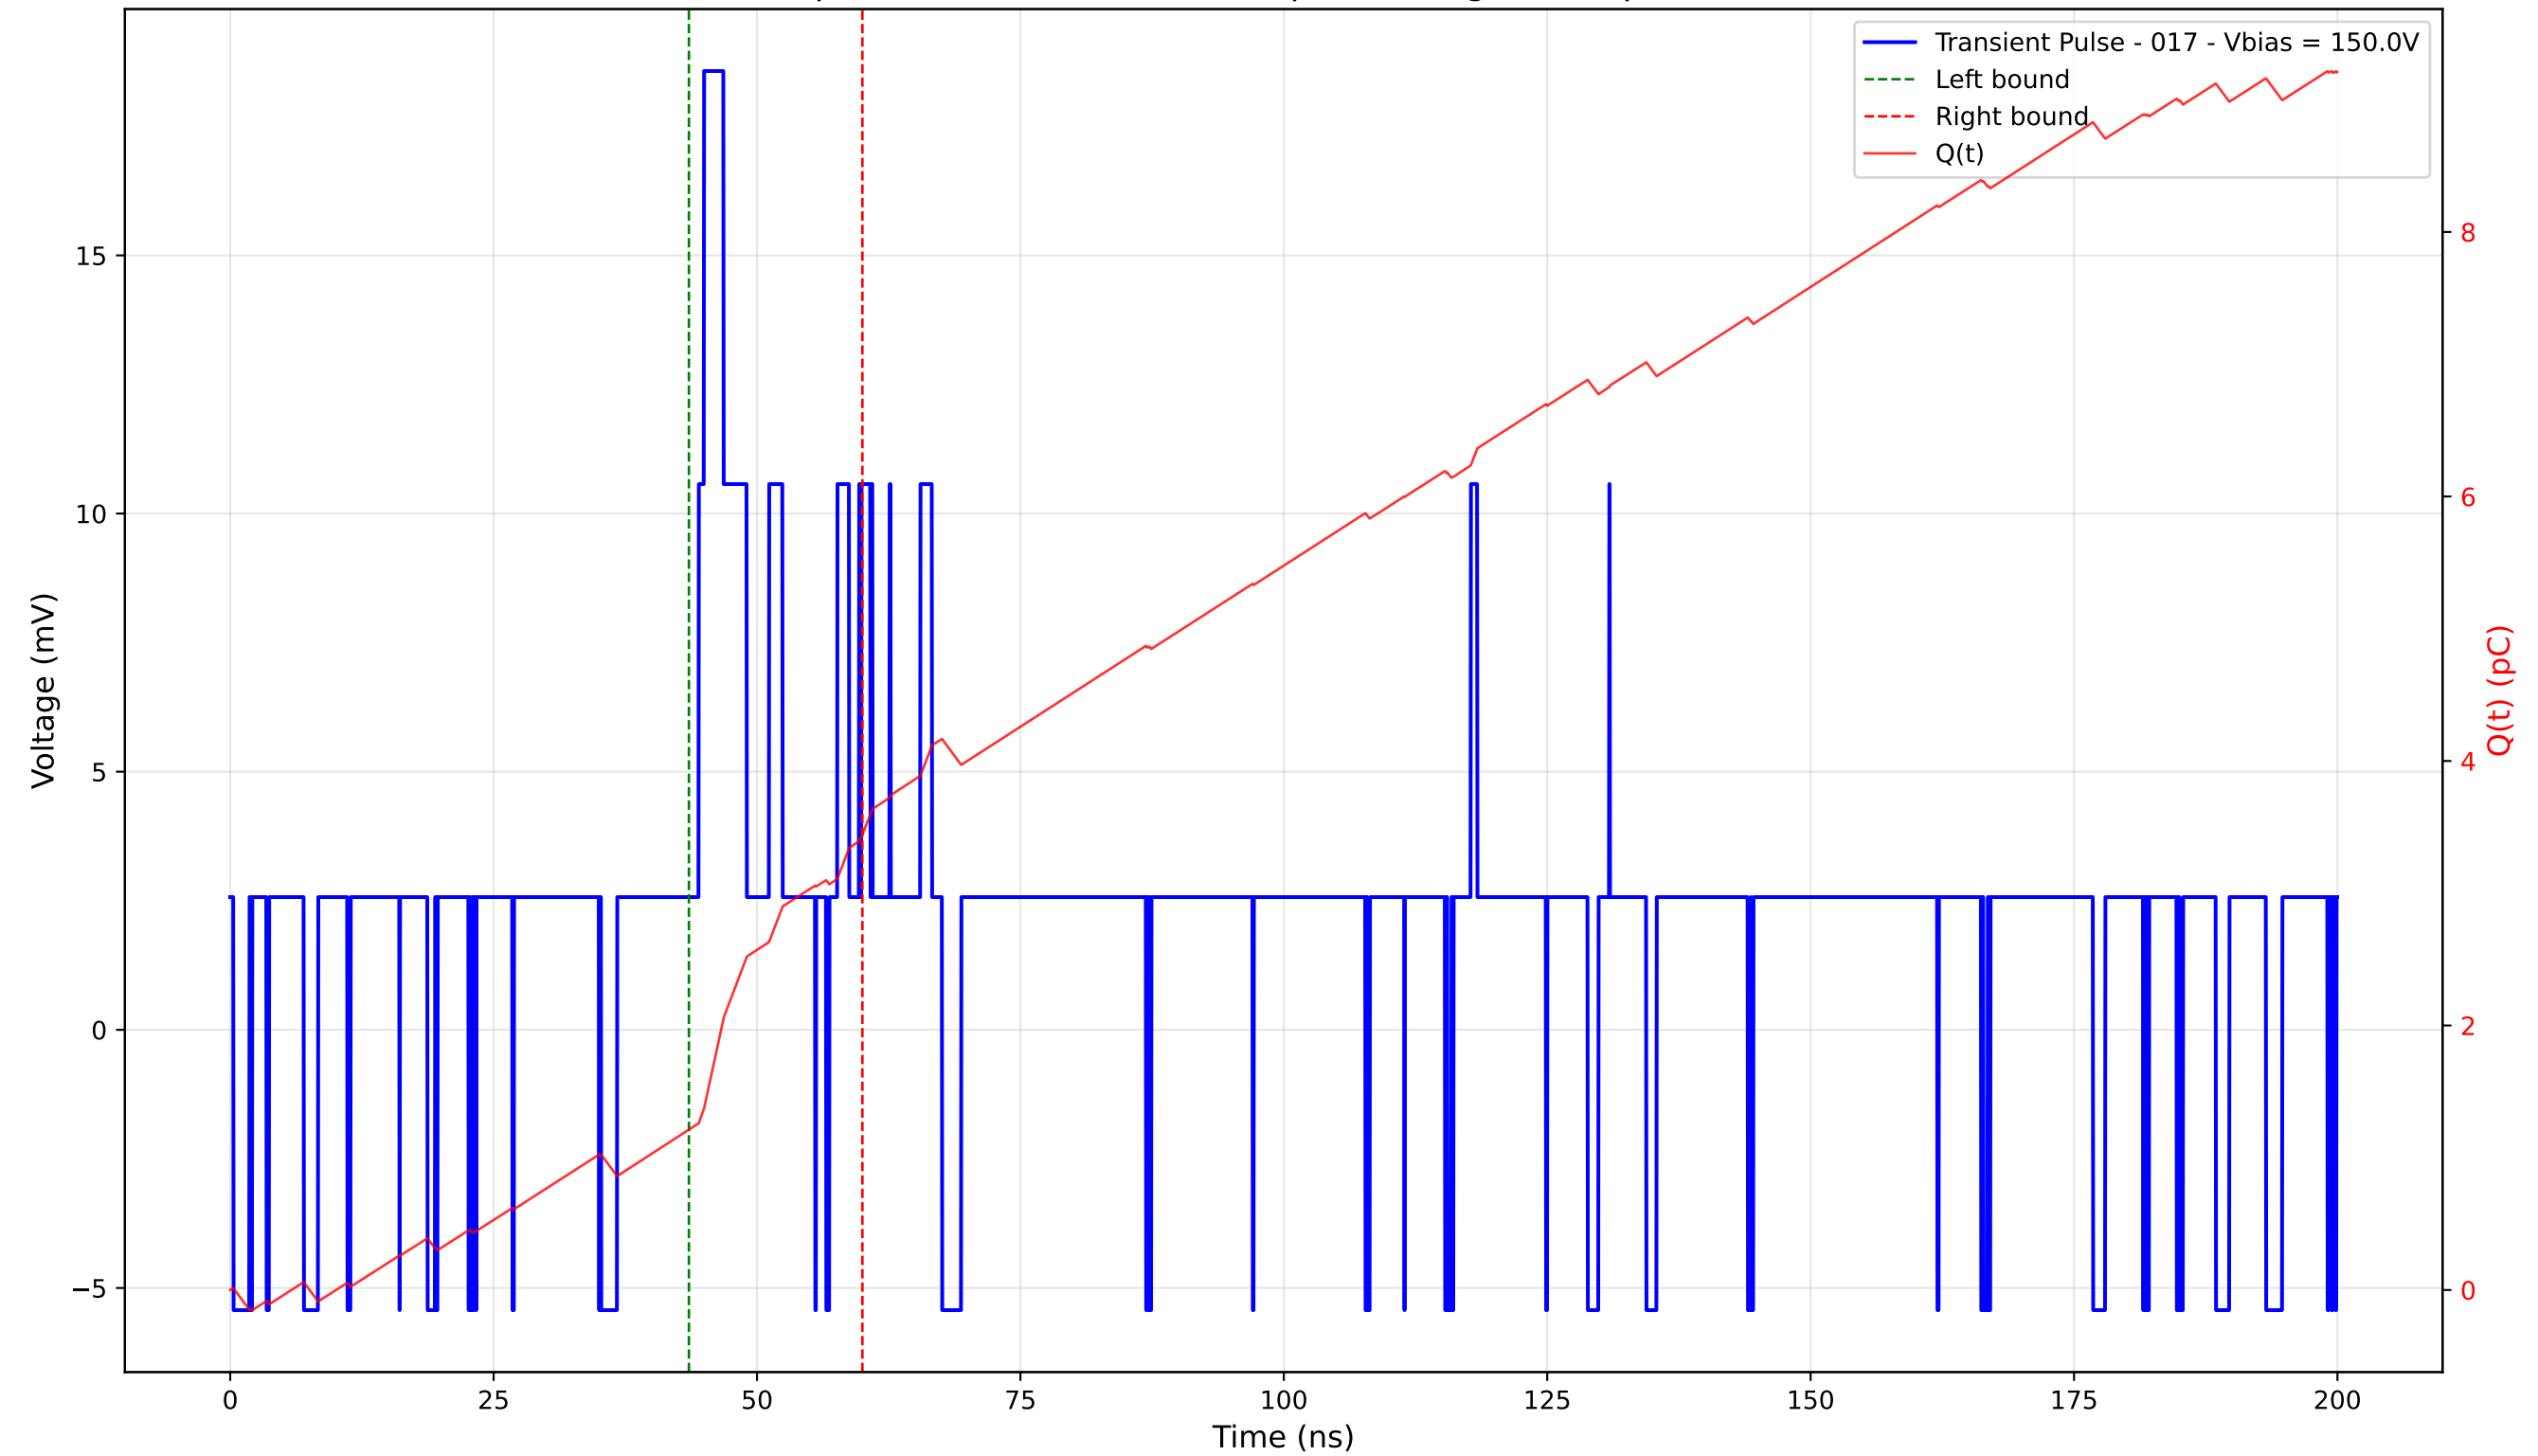

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 1.18 pC - Rise Time: 0.60 ns



Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 1.94 pC - Rise Time: 1.72 ns

