


TCT Run 020 Summary

Parameter	Value
Run	Run020
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	120.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\120V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

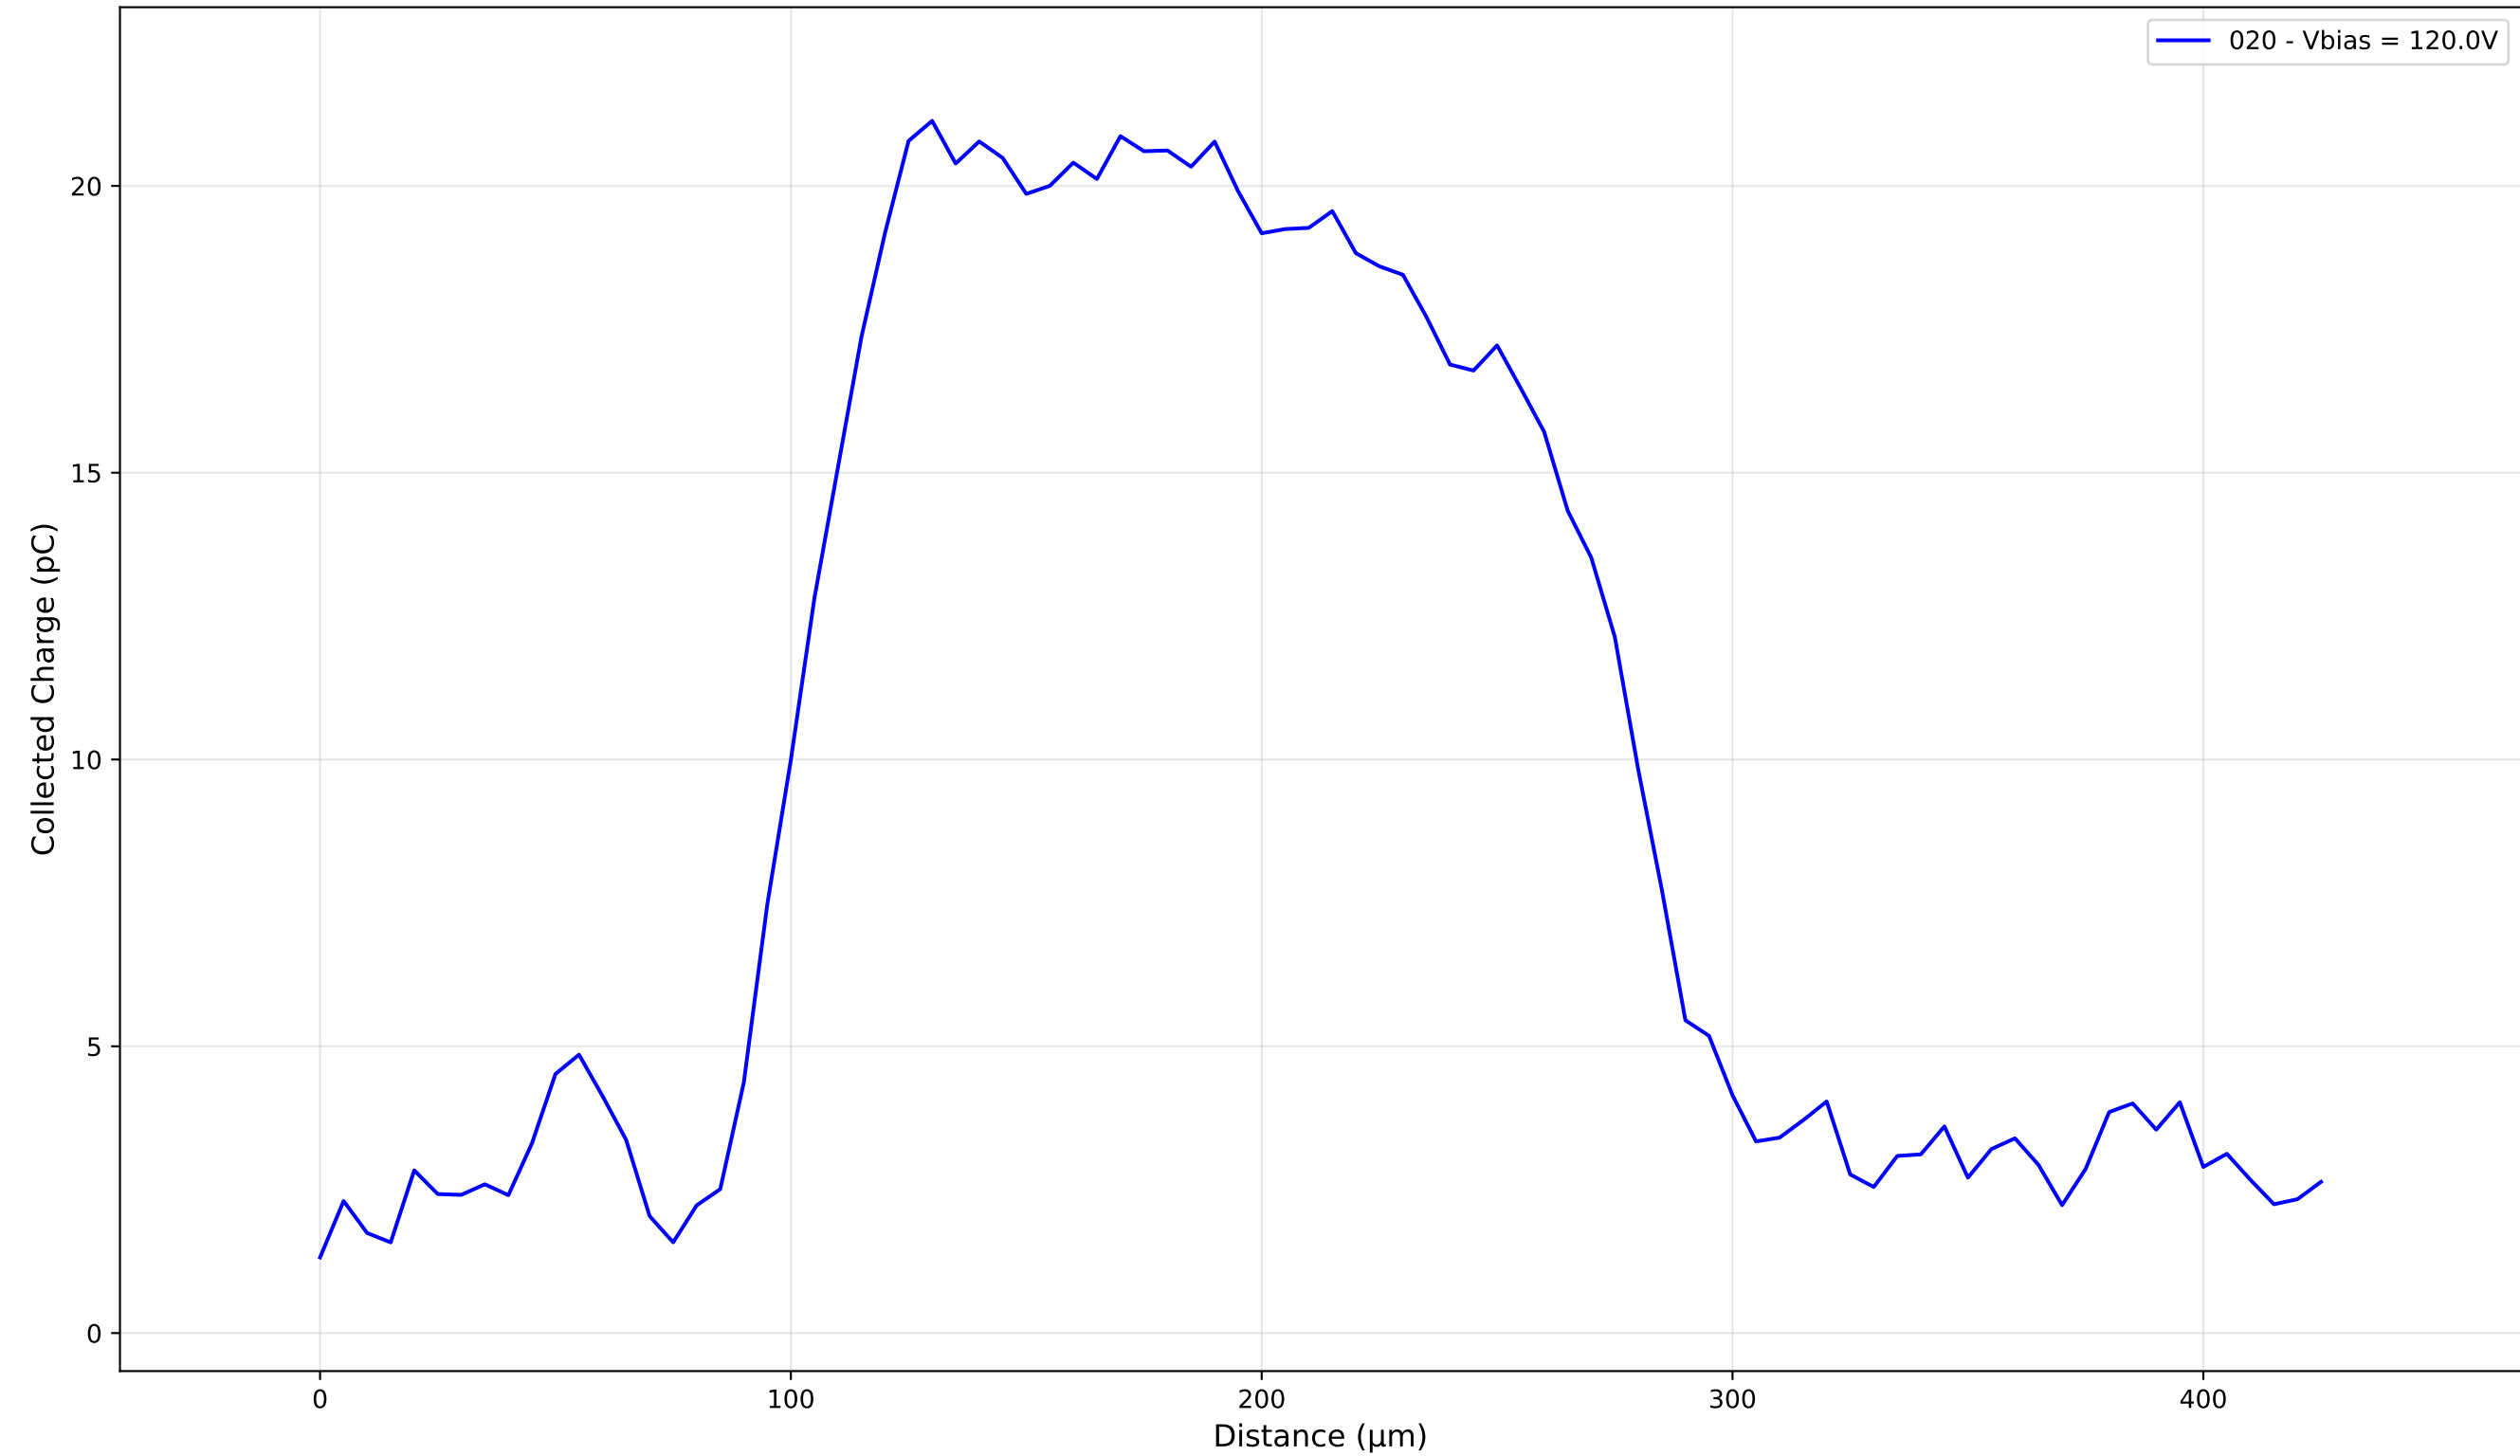

Collected Charge

020 - Vbias = 120.0V

Collected Charge [a.u.]

1.0

0.8

0.6

0.4

0.2

0.0

0


100

200

300


400

Distance (μm)

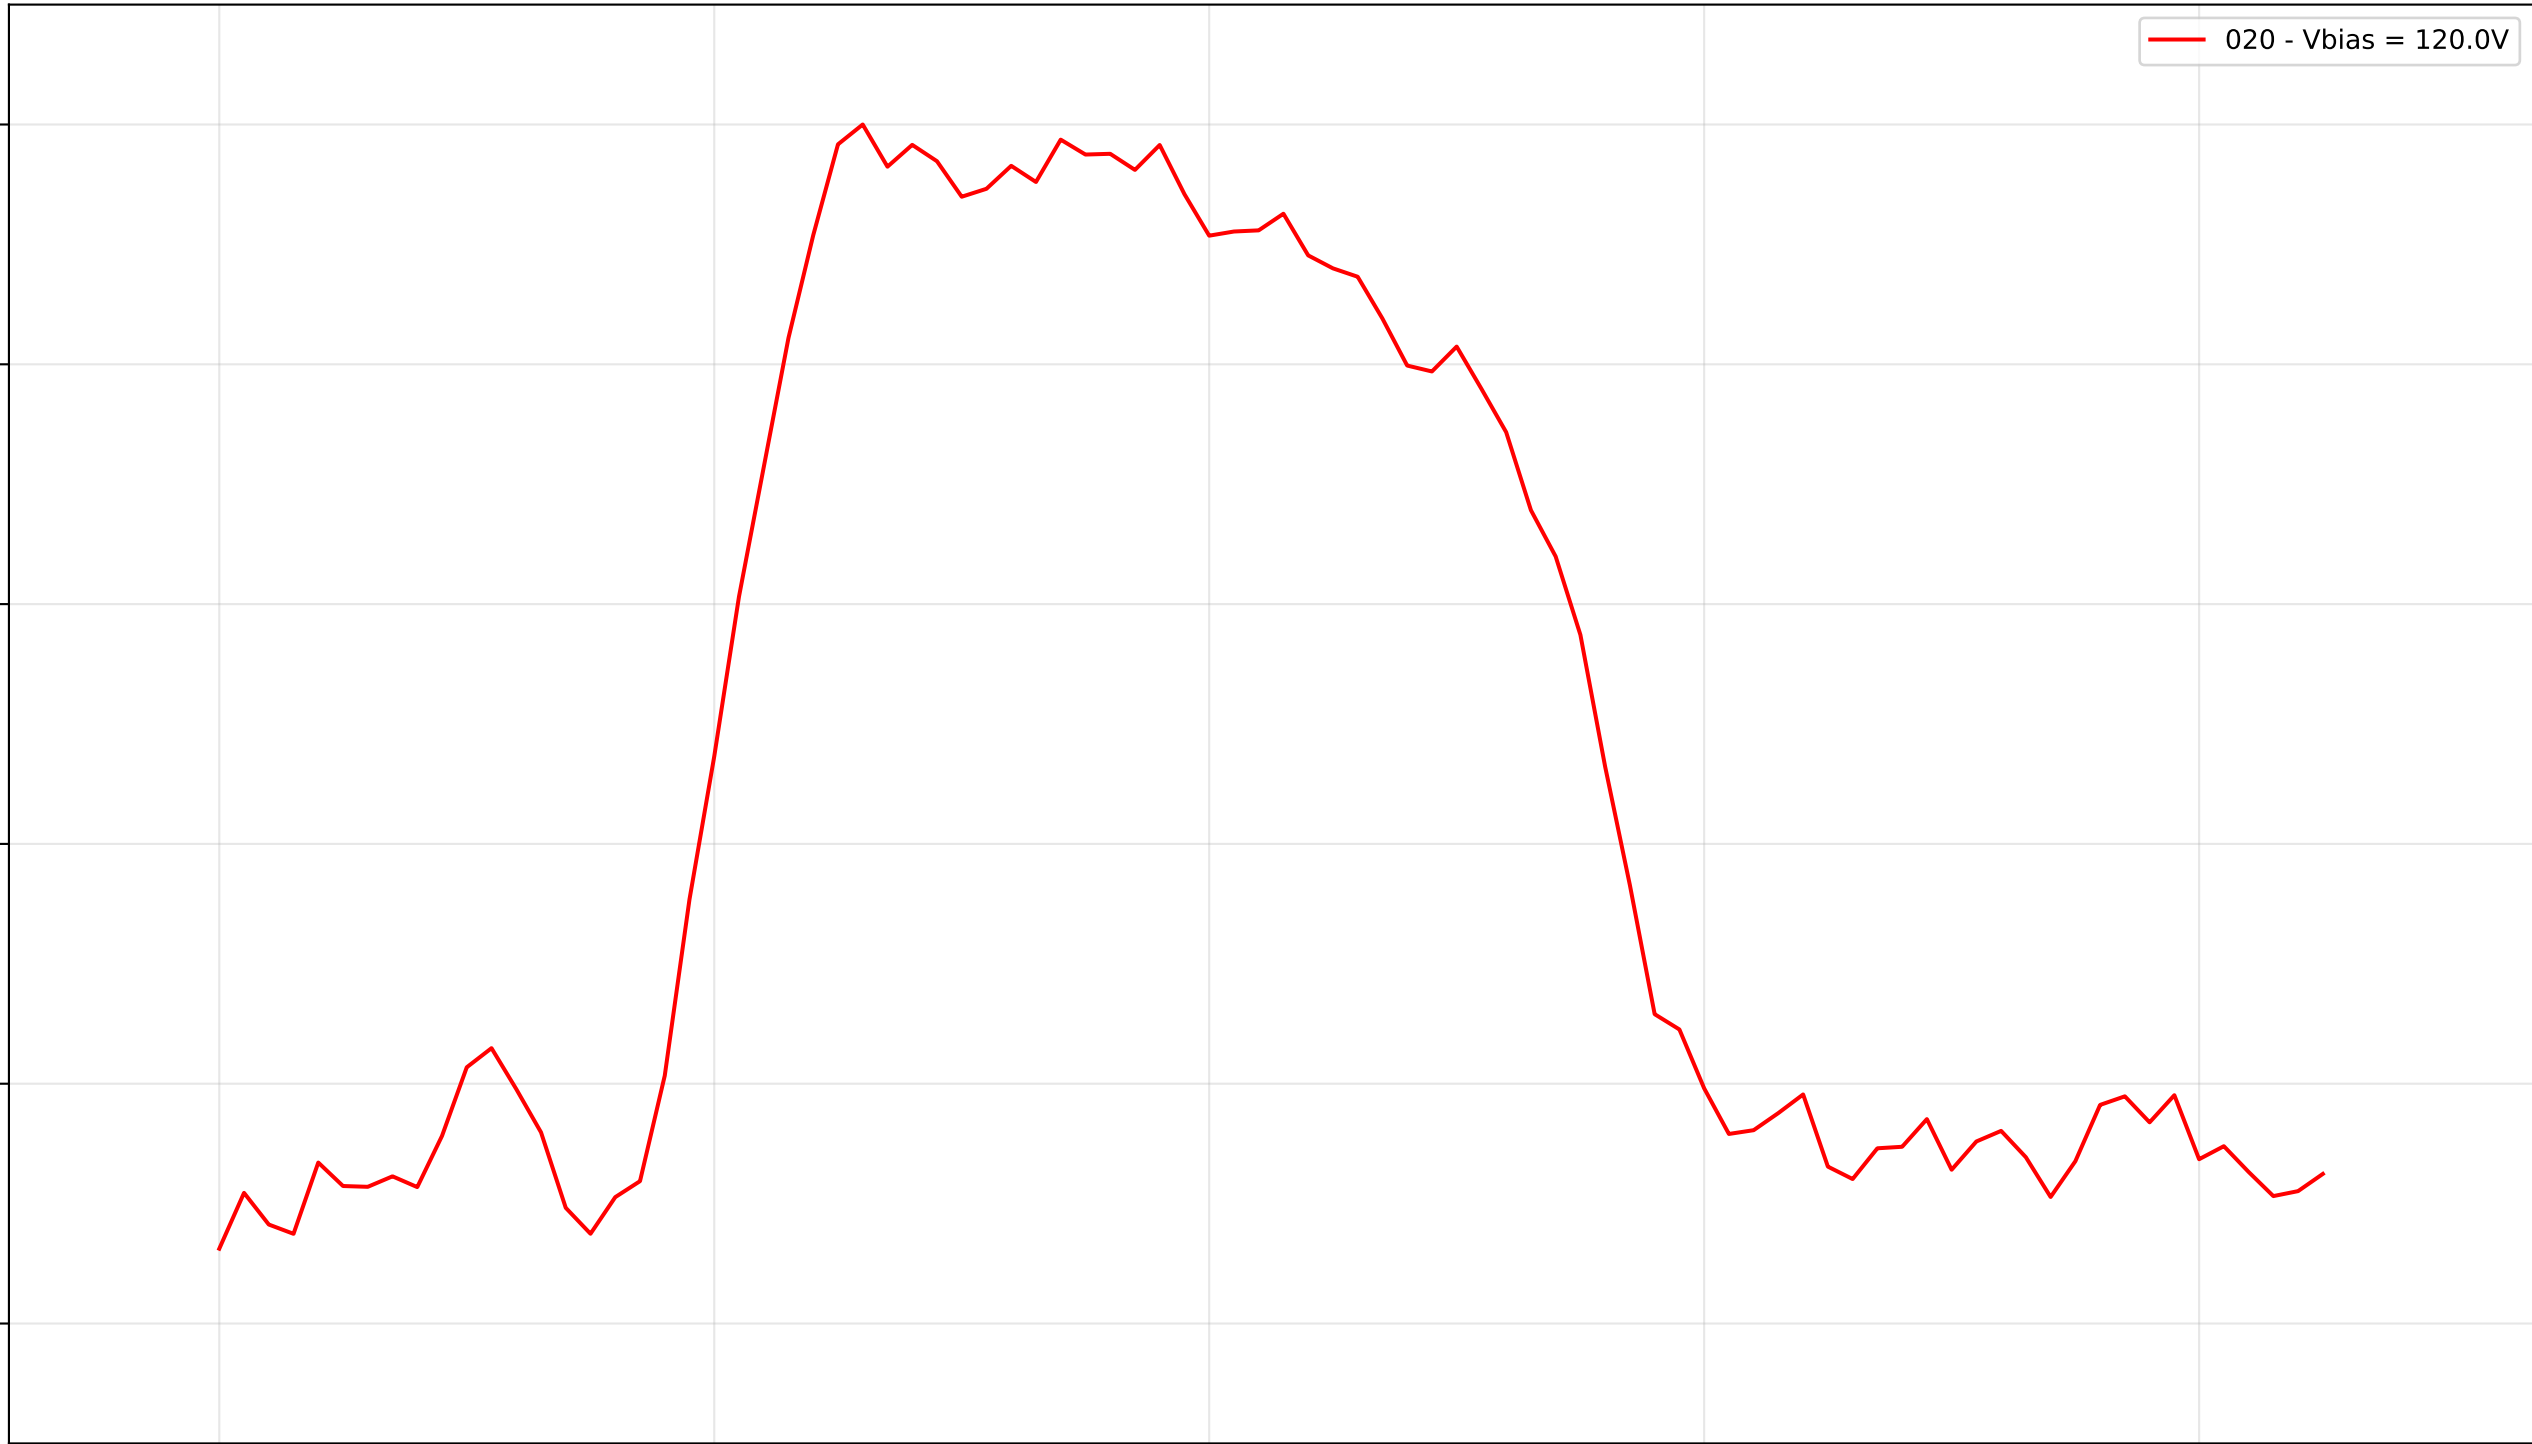


Rise Time


020 - Vbias = 120.0V

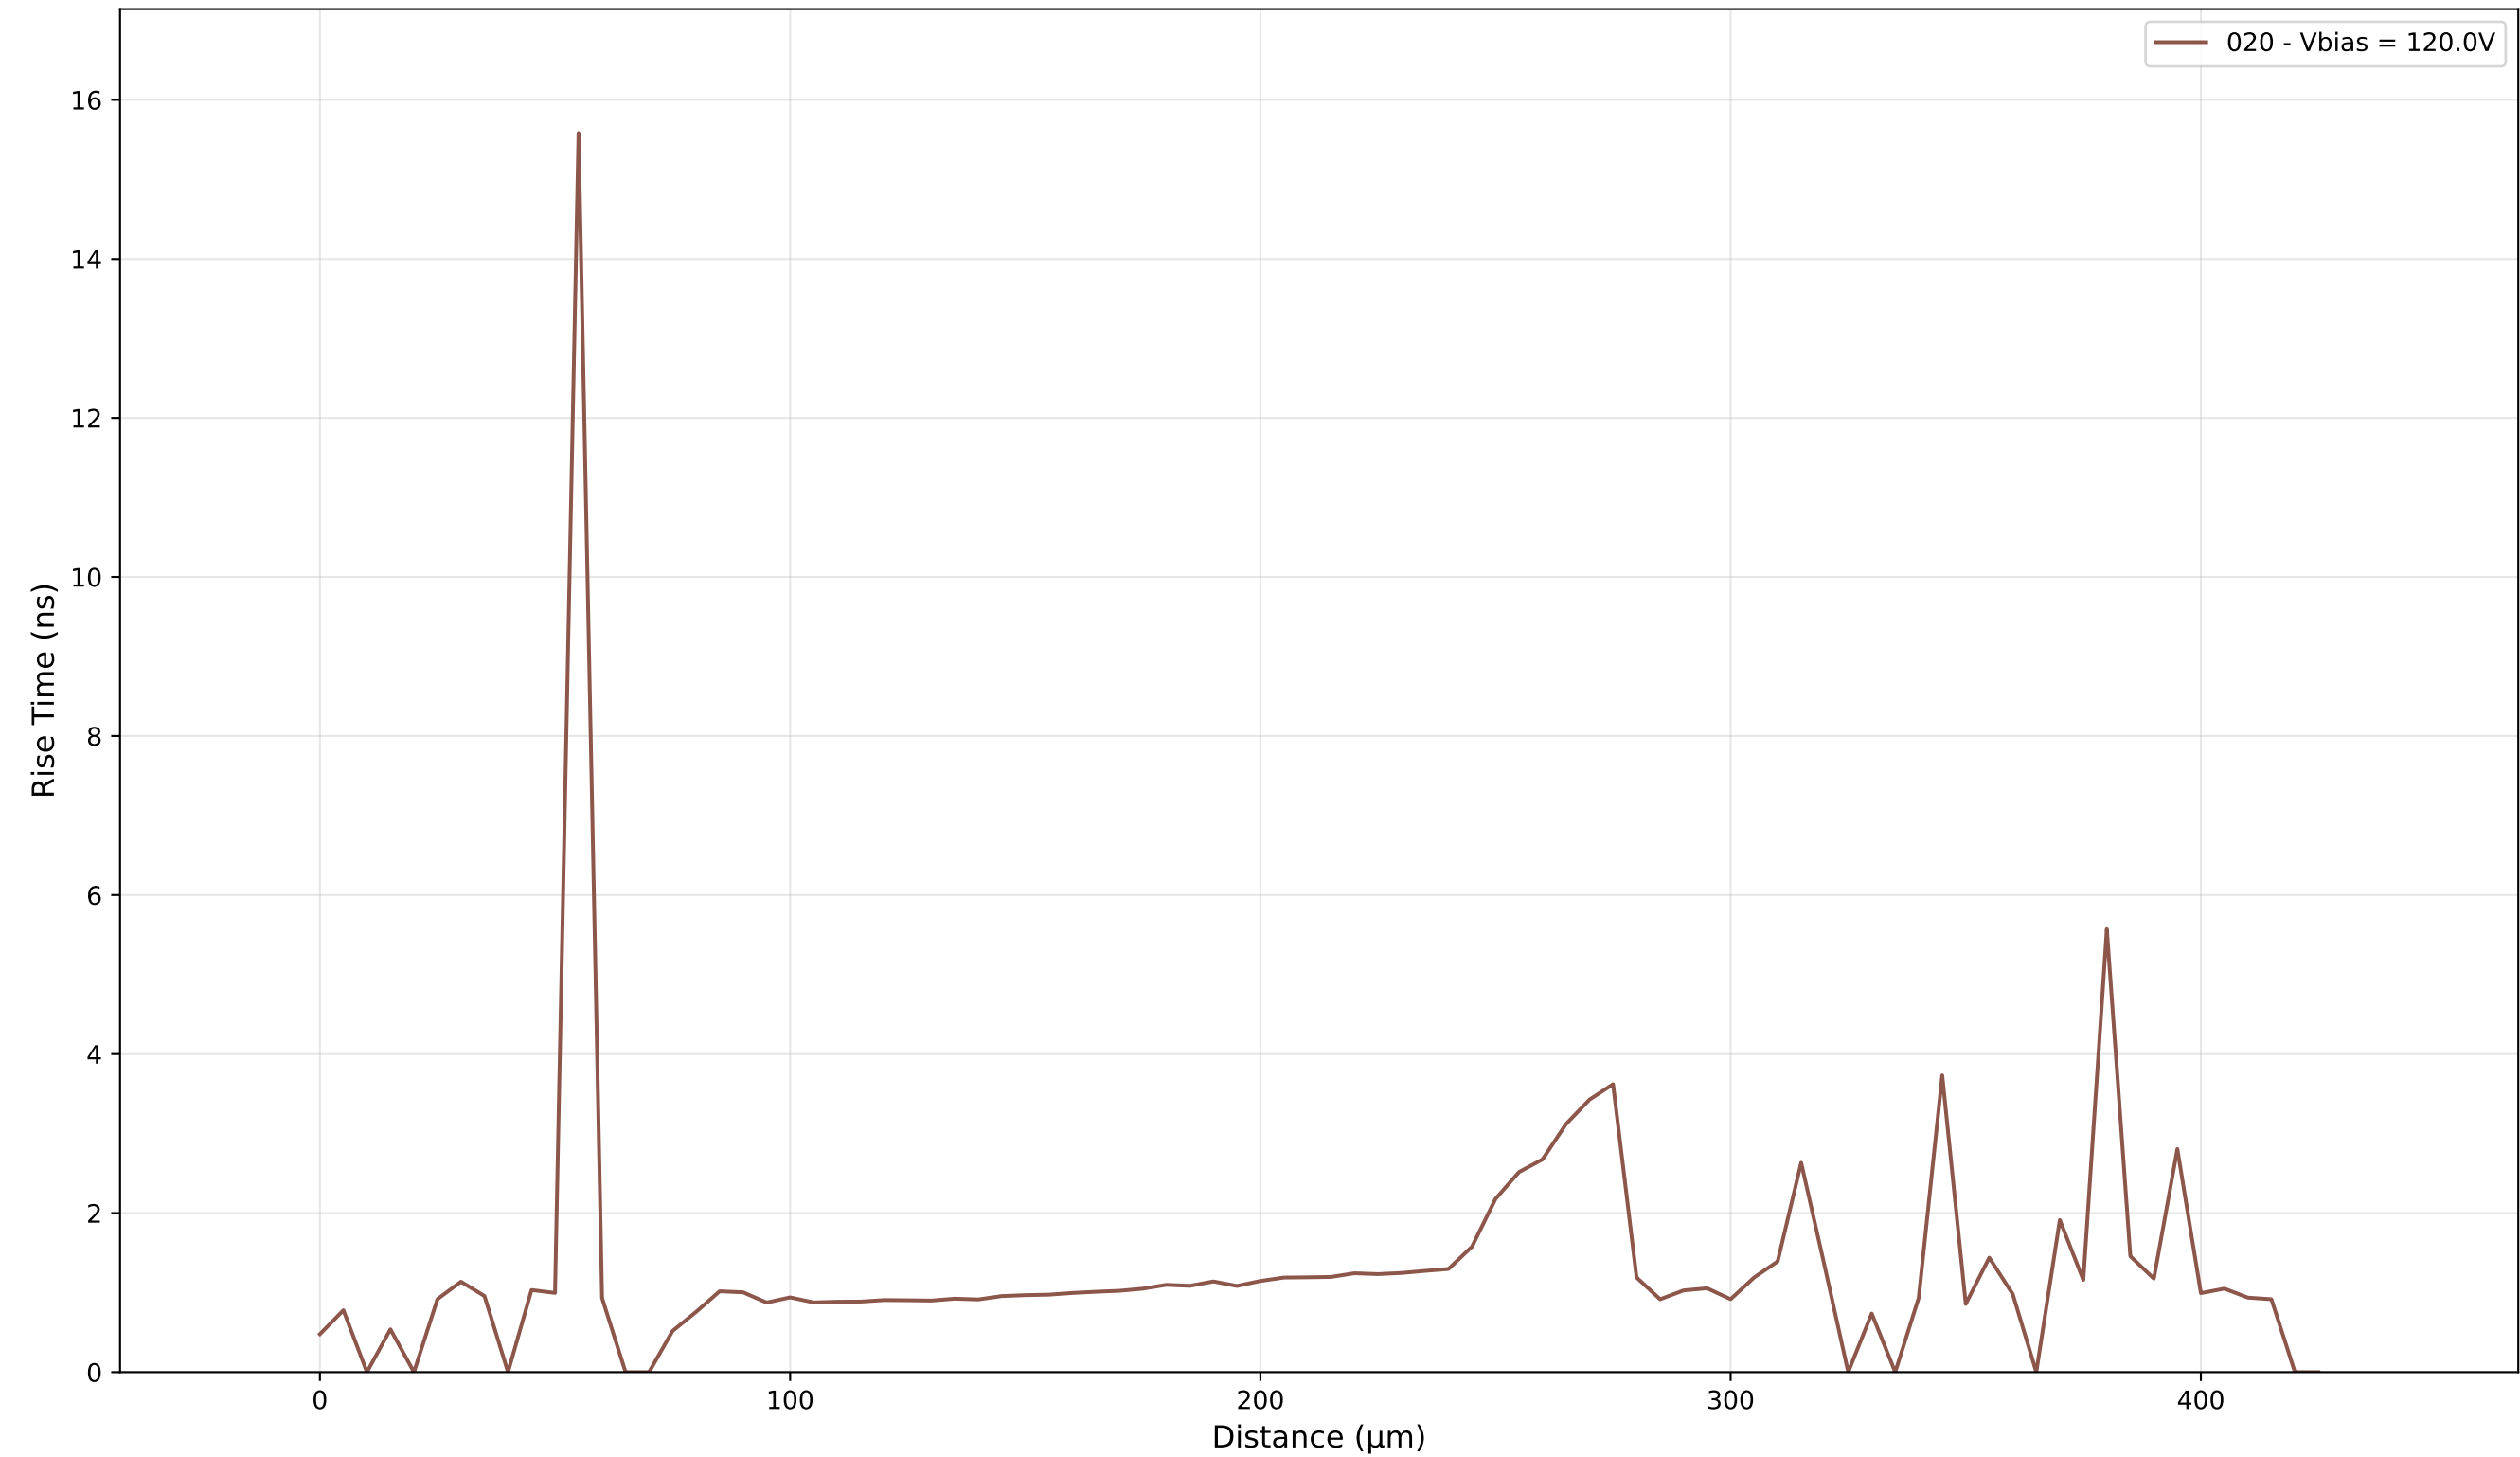


Amplitude

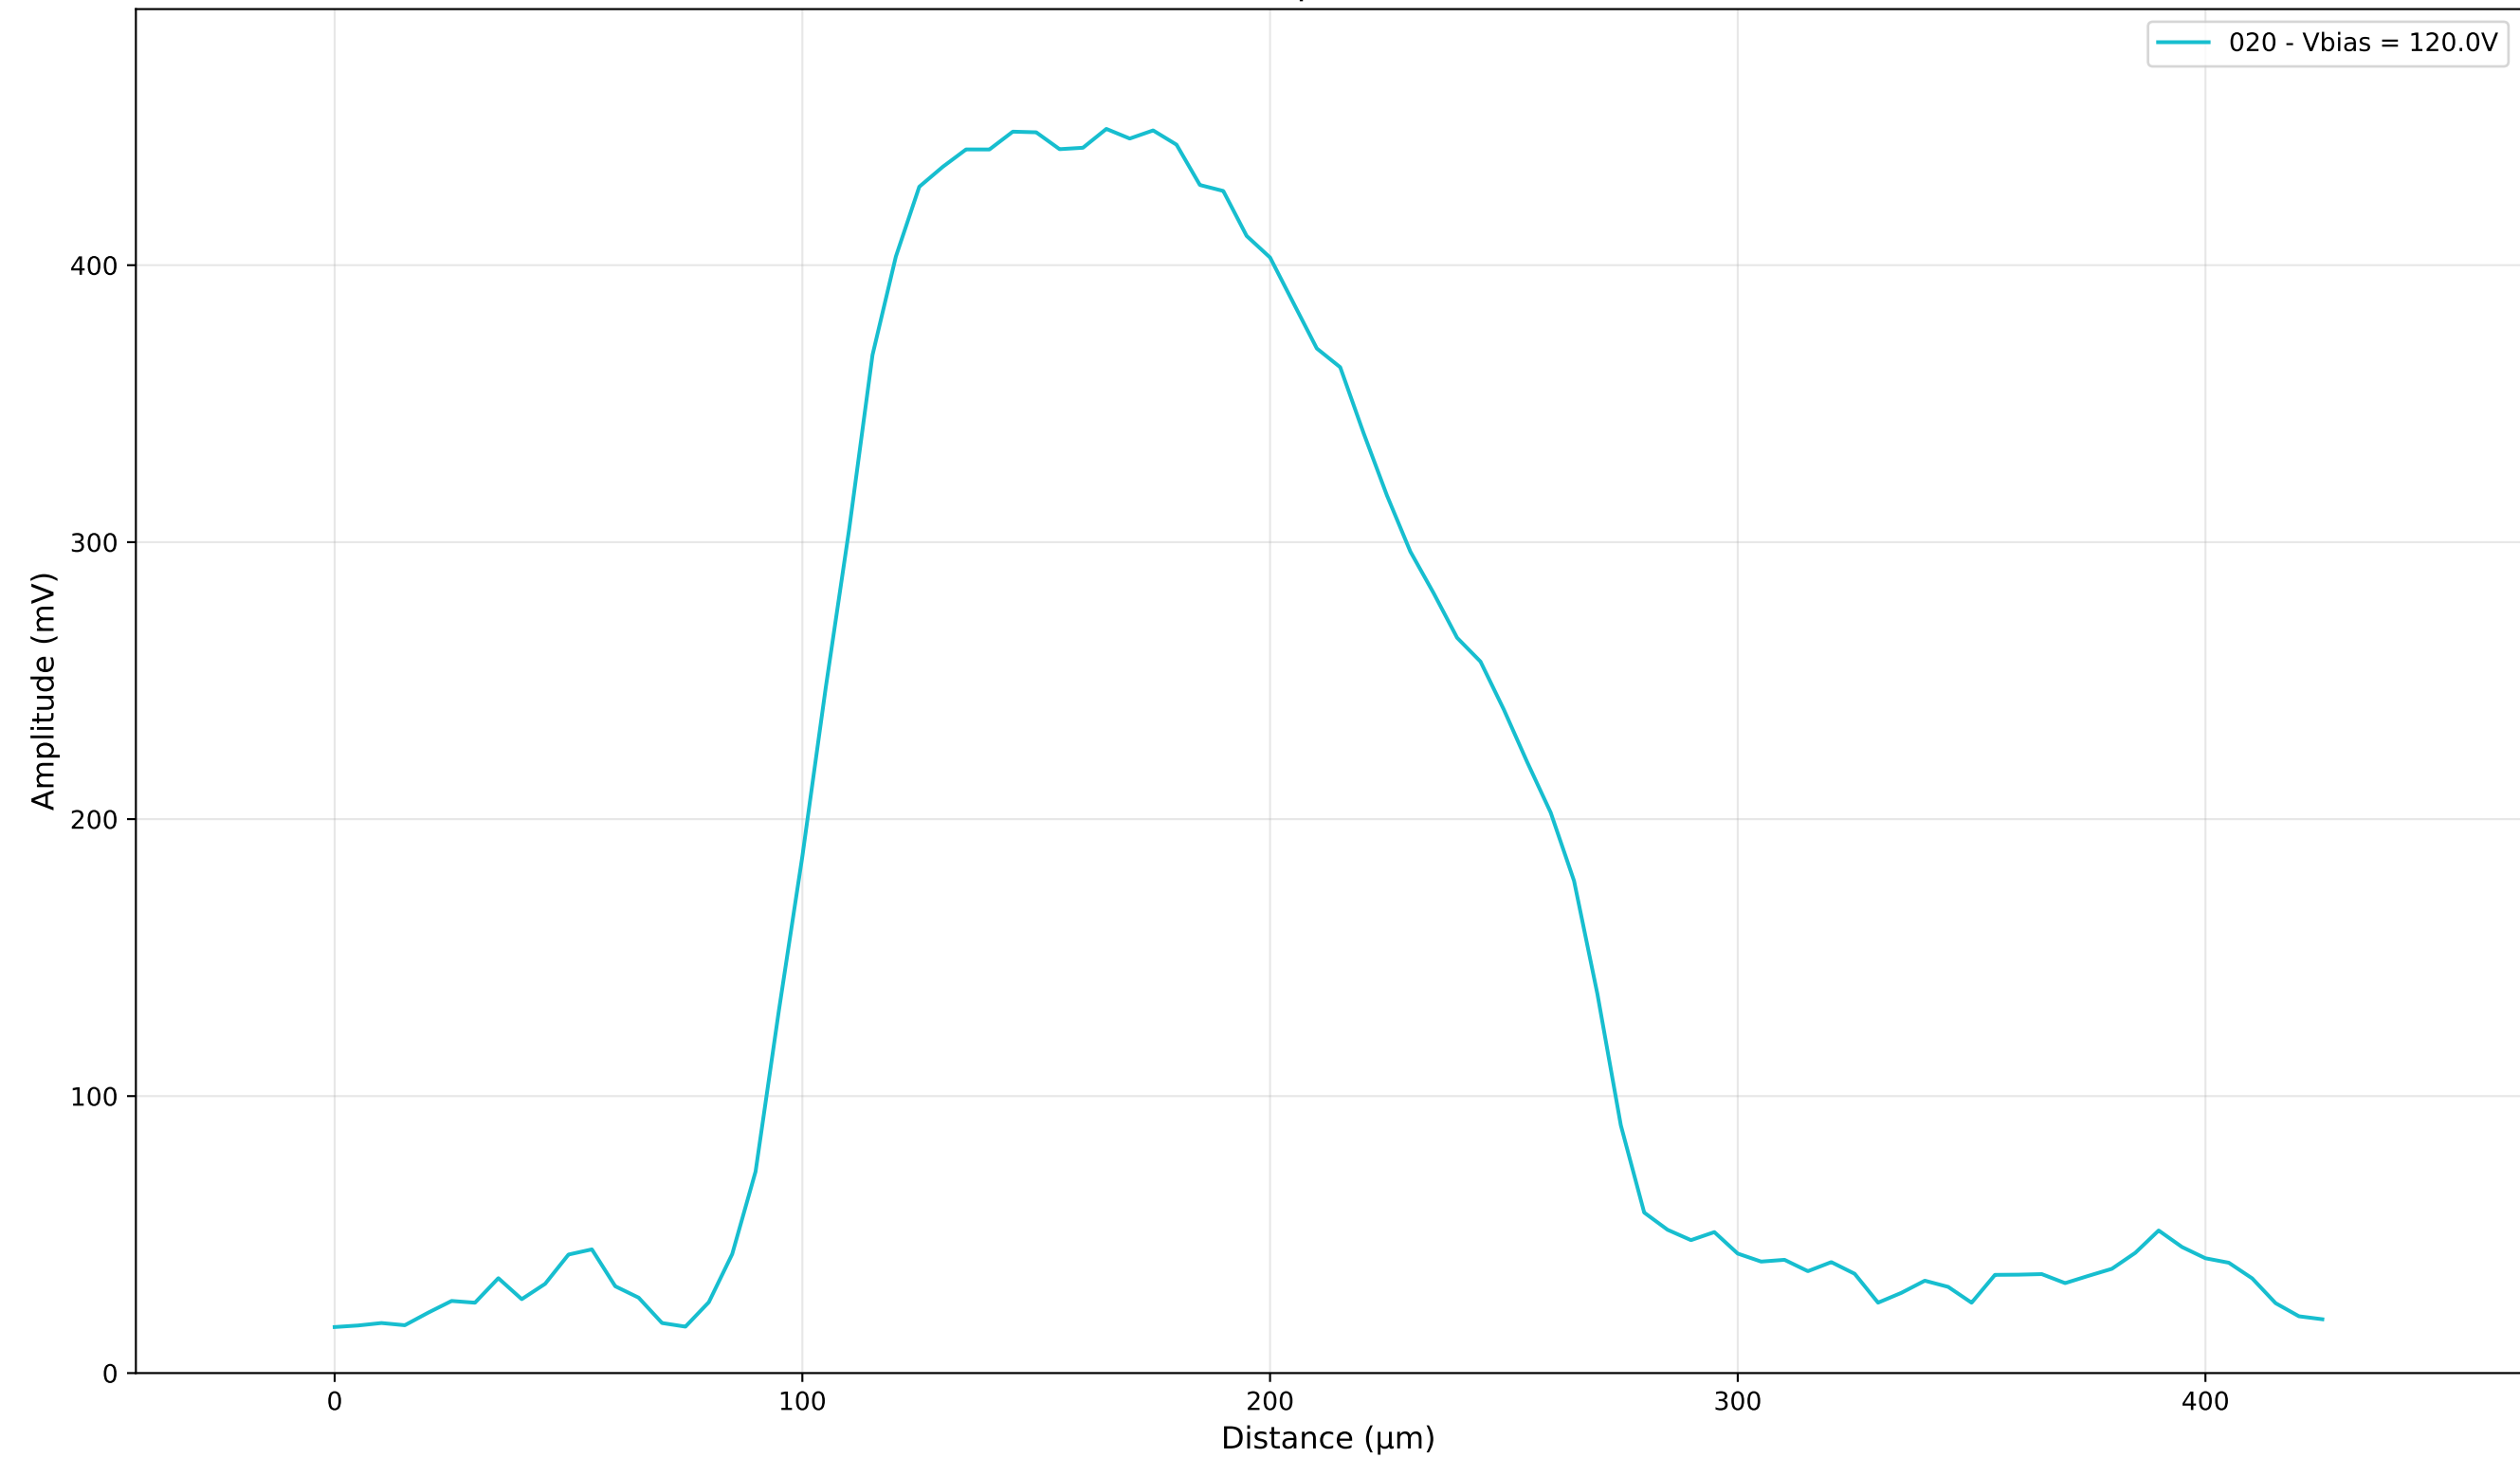


FWHM

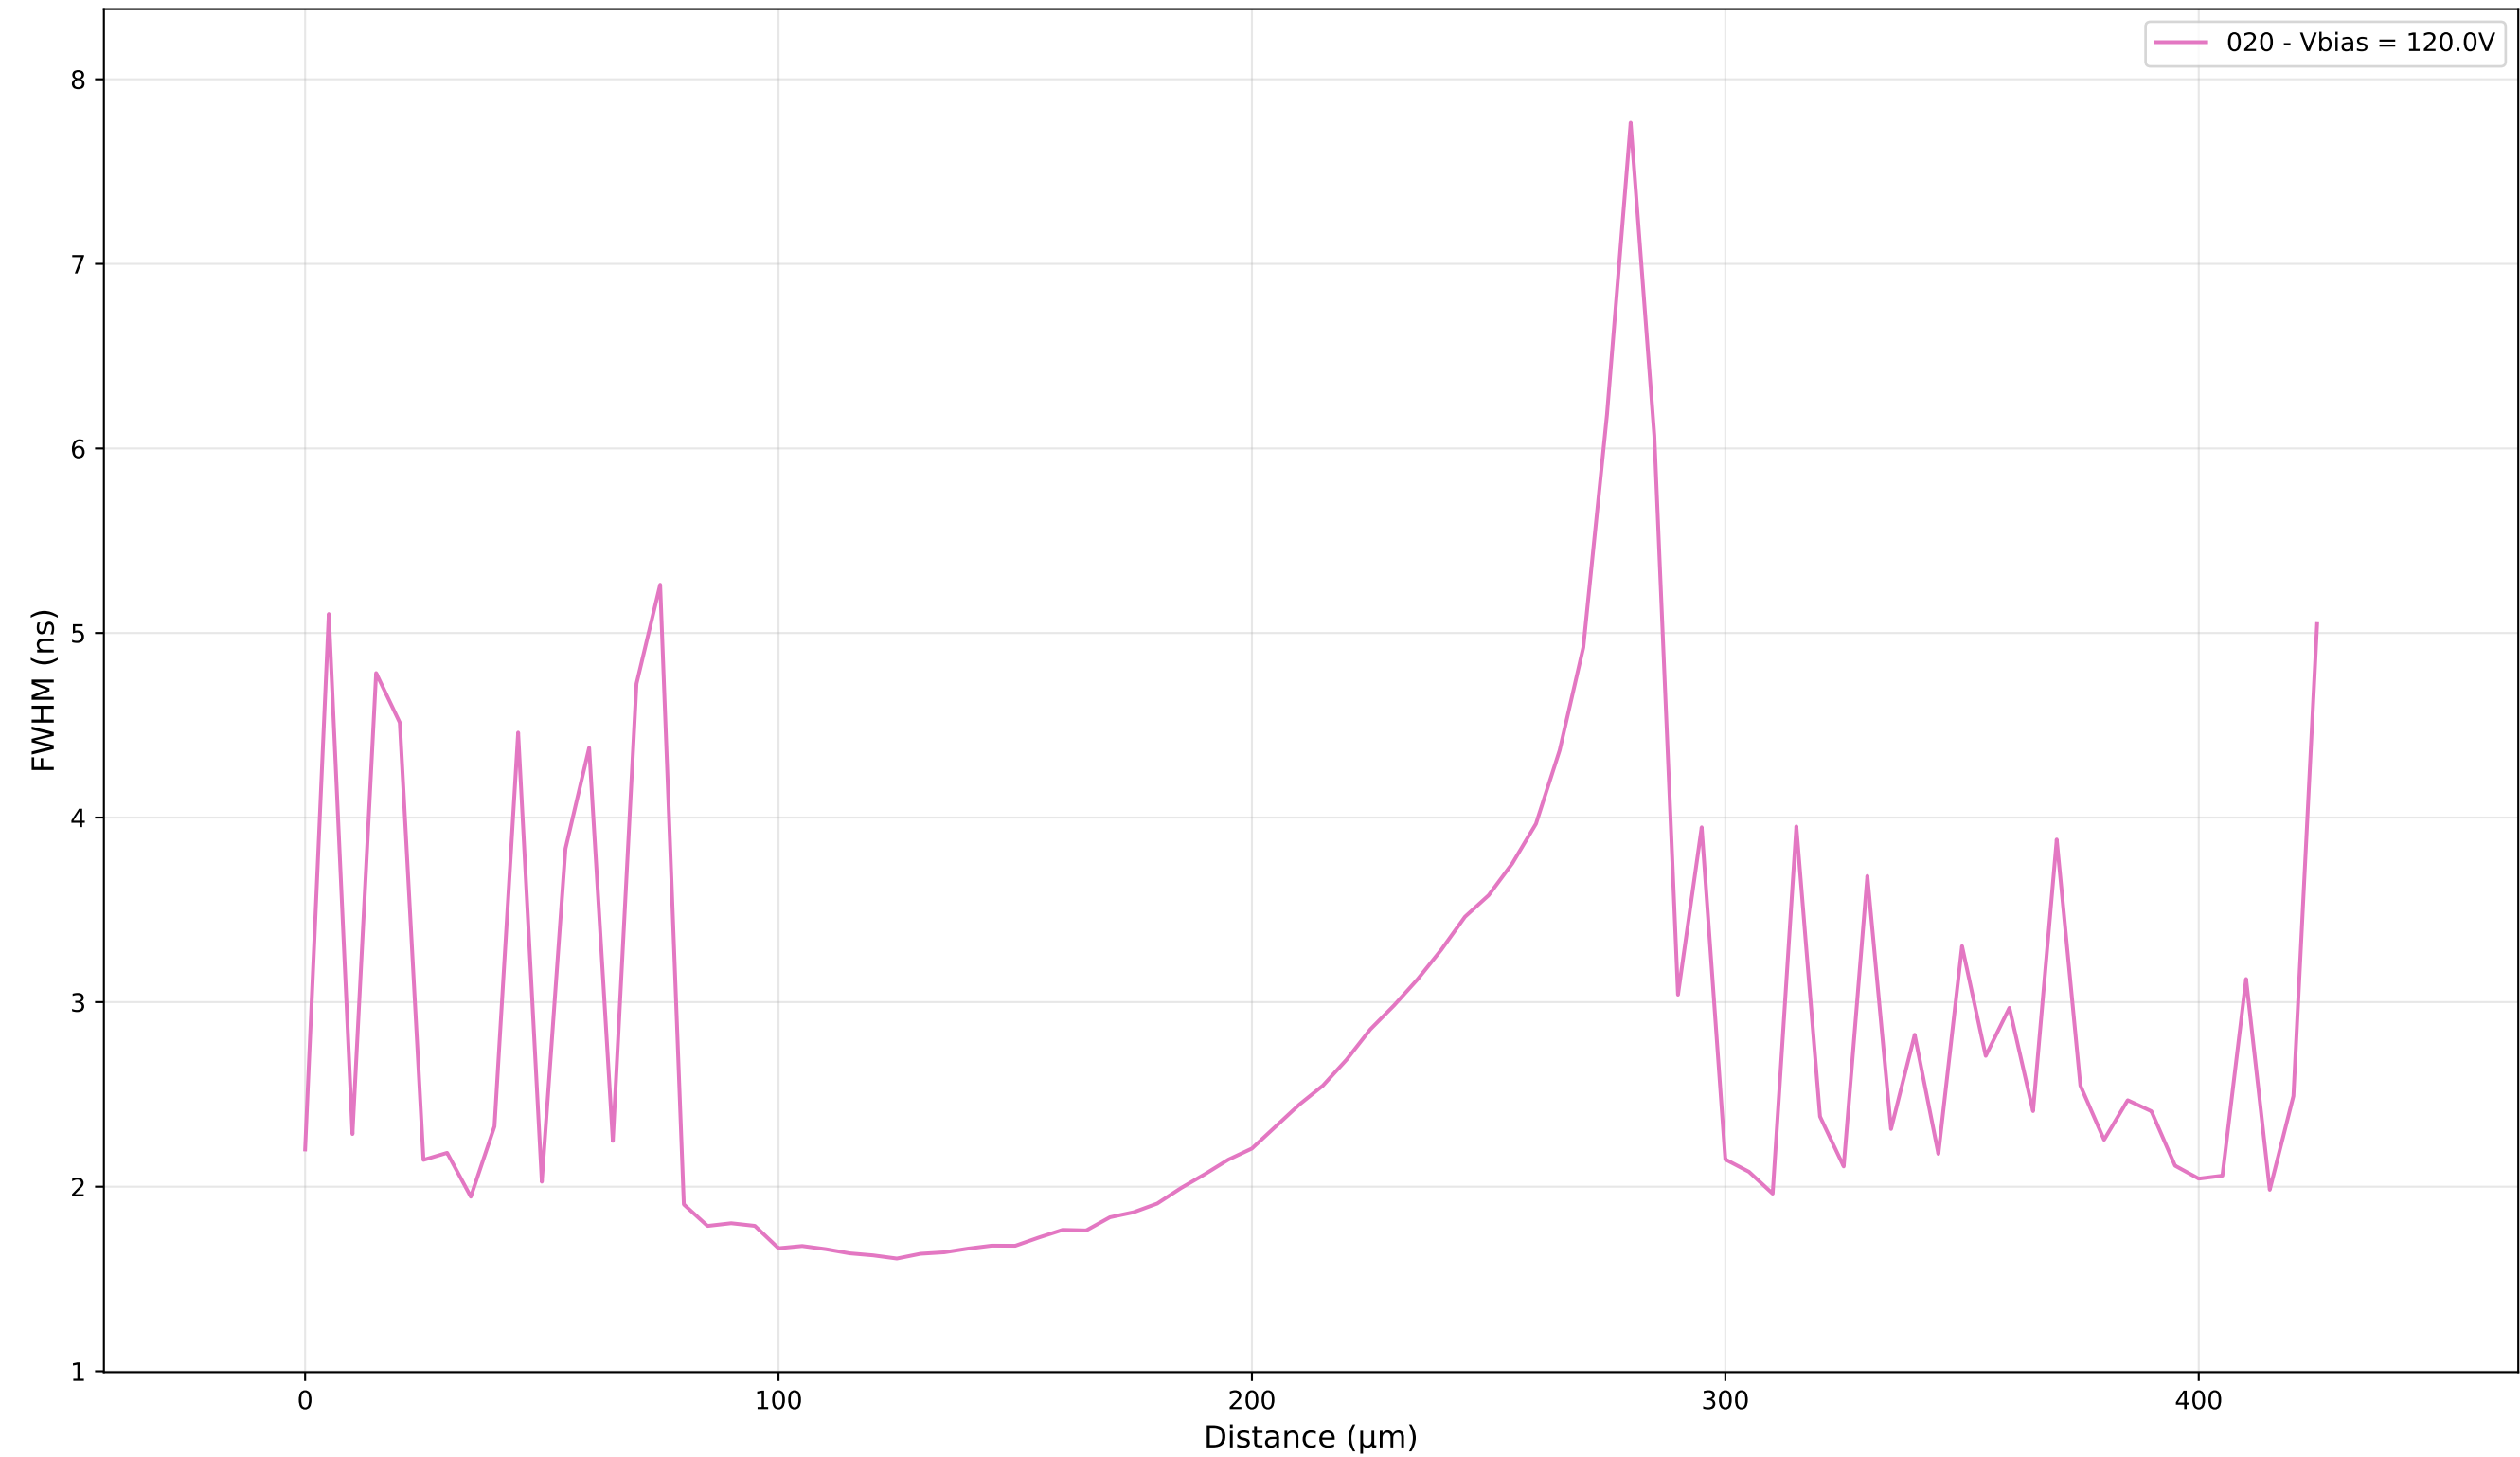


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 1.32 pC - Rise Time: 0.48 ns

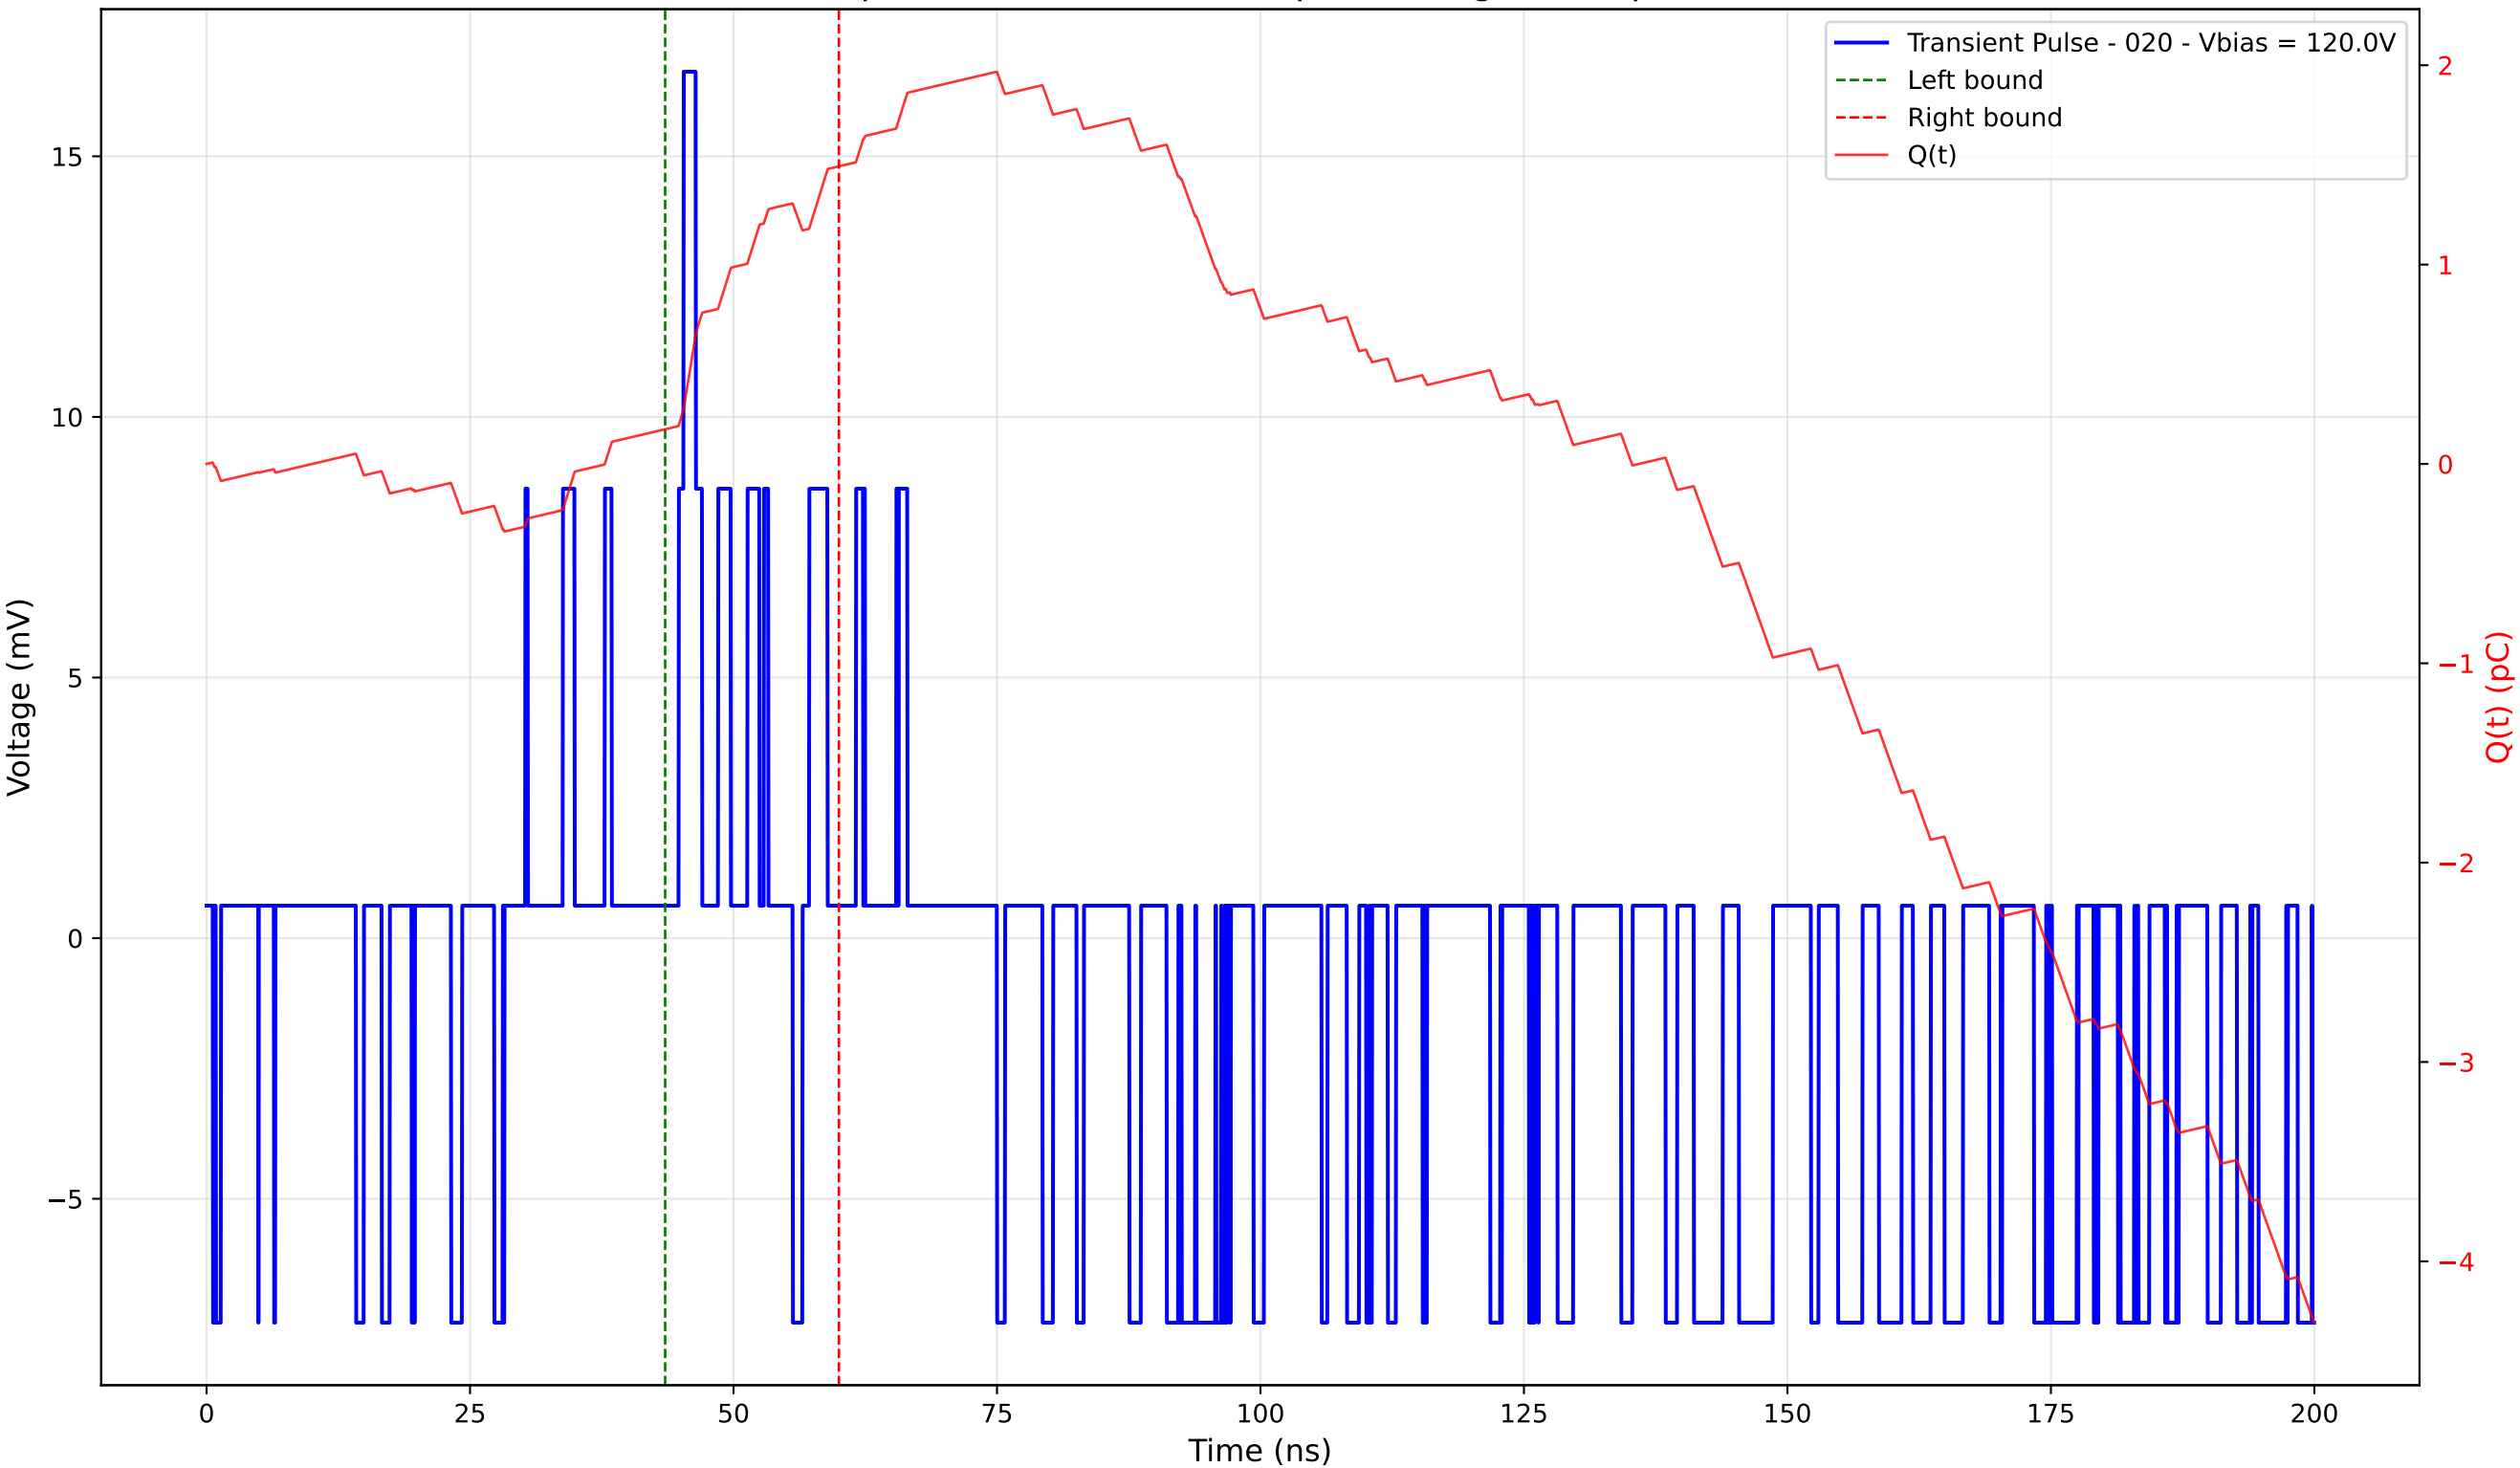


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 2.30 pC - Rise Time: 0.78 ns

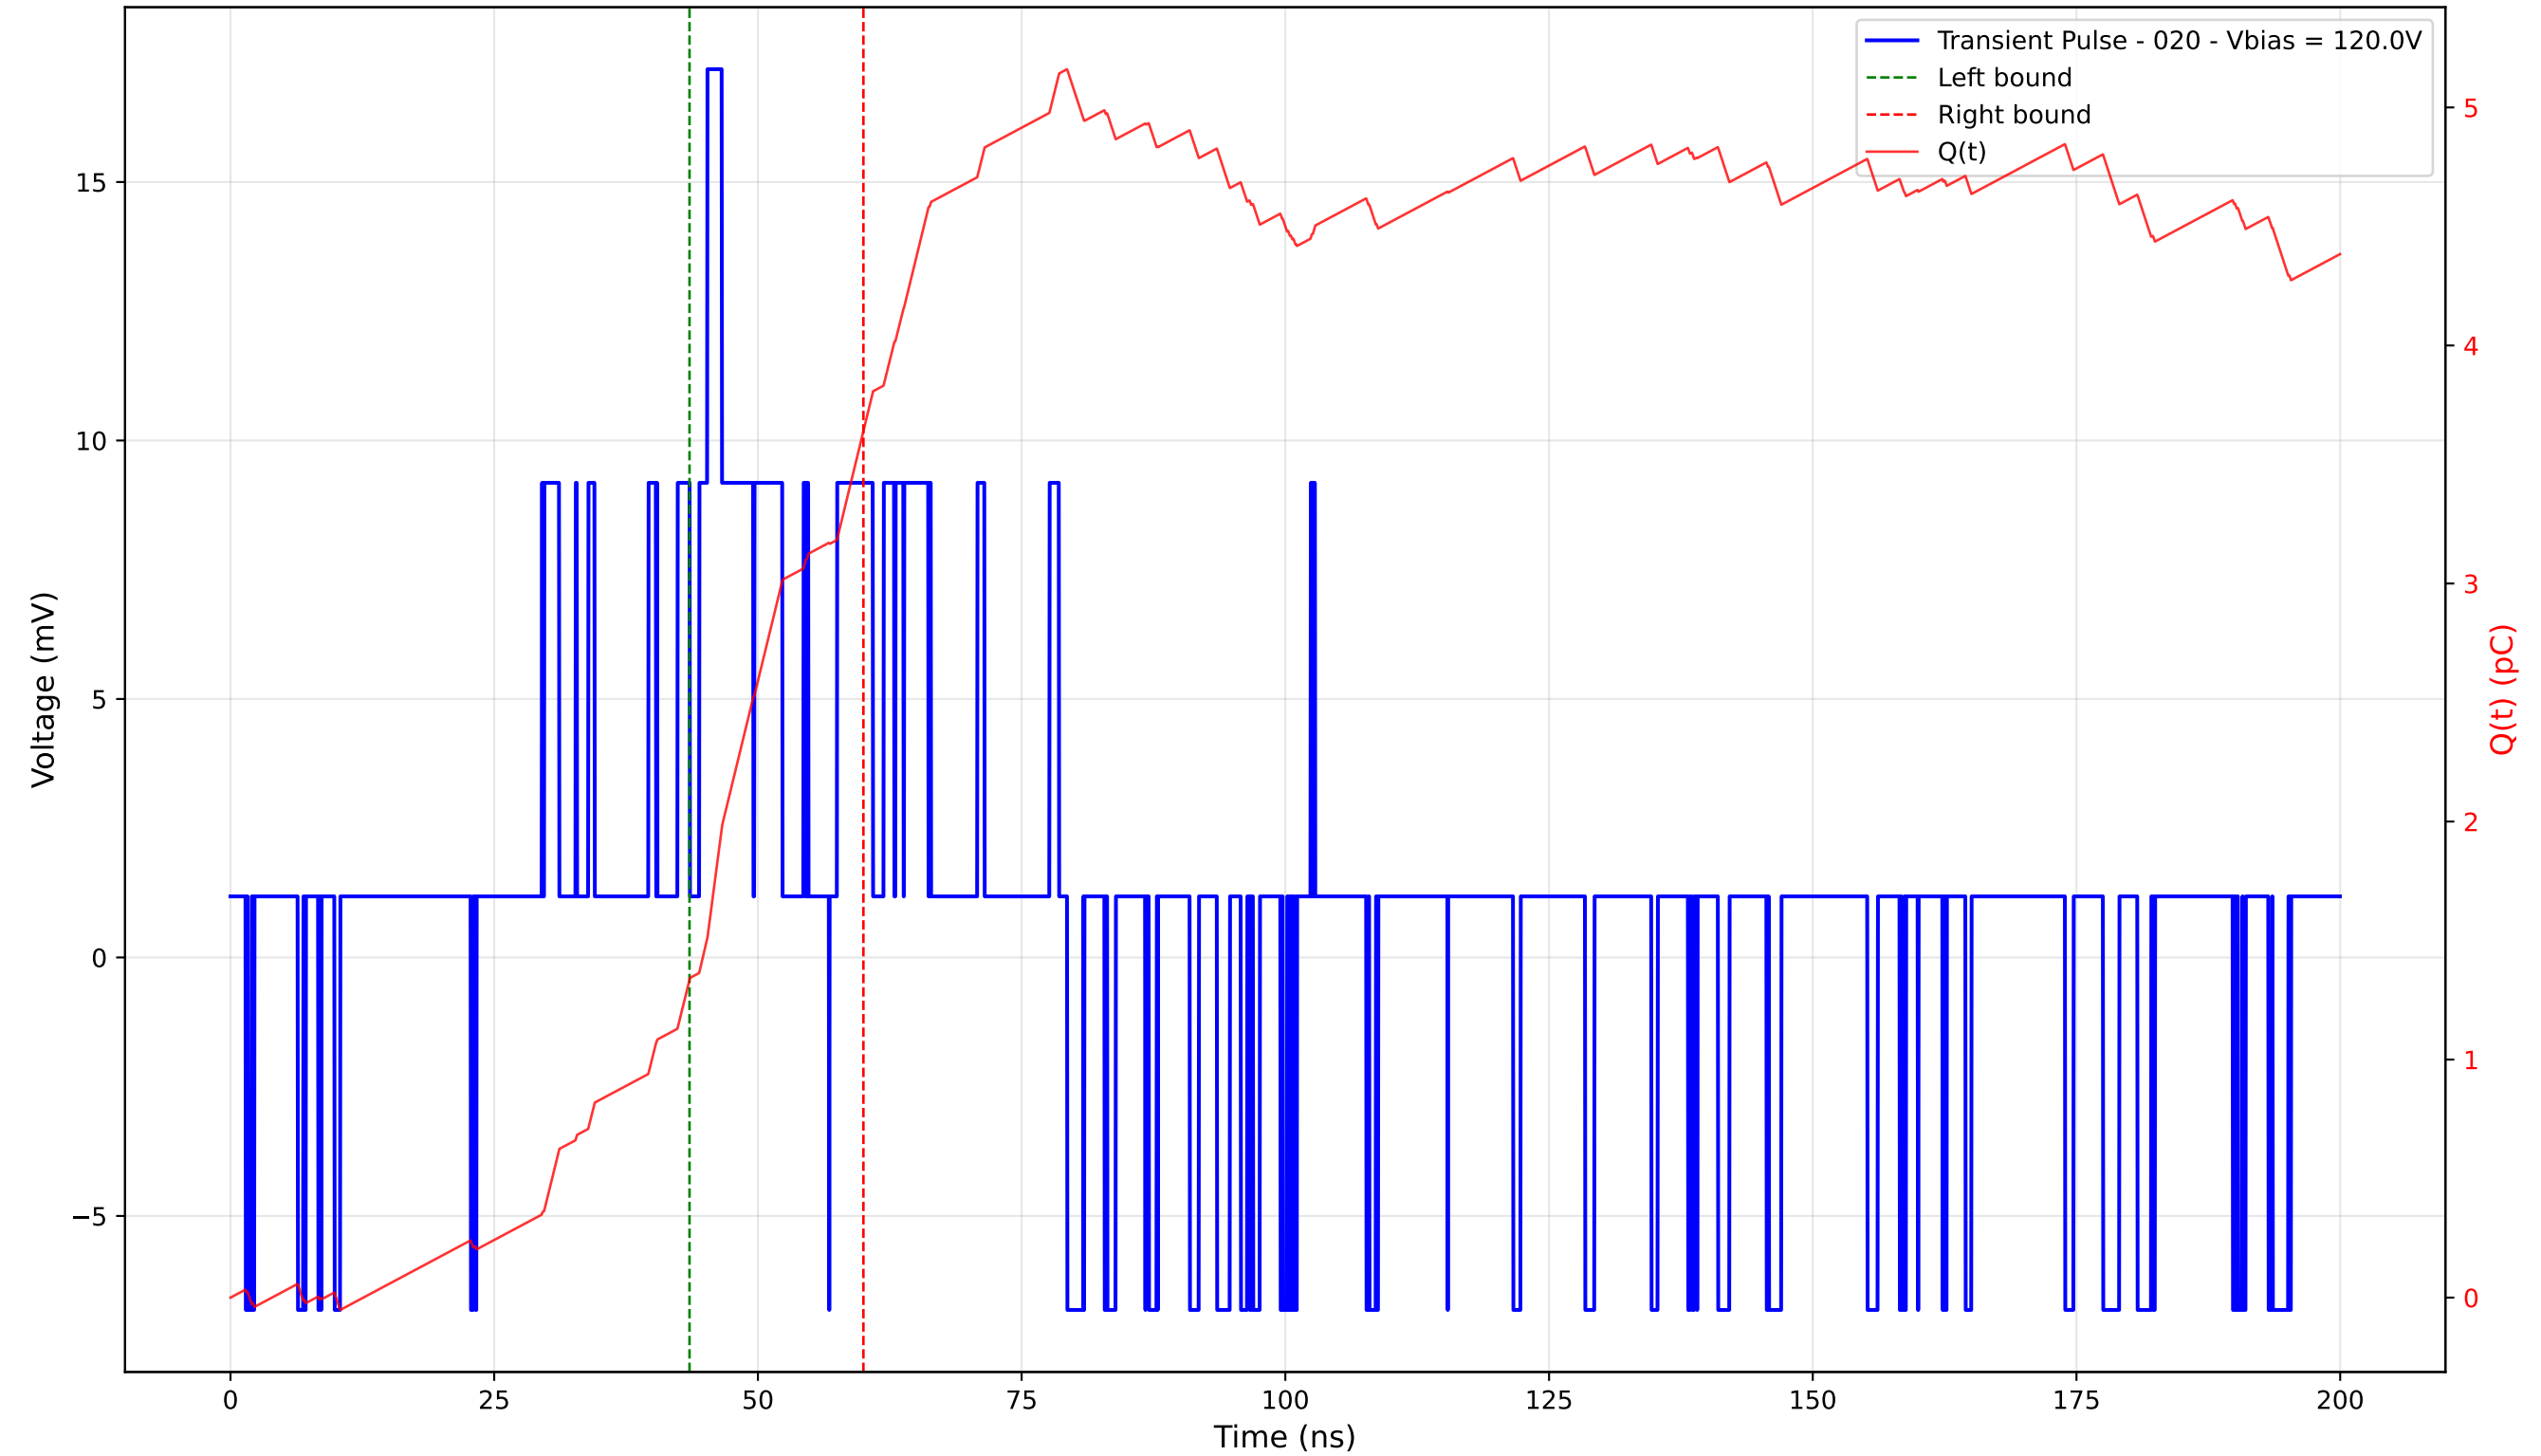


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 1.74 pC - Rise Time: 0.00 ns (N/A)

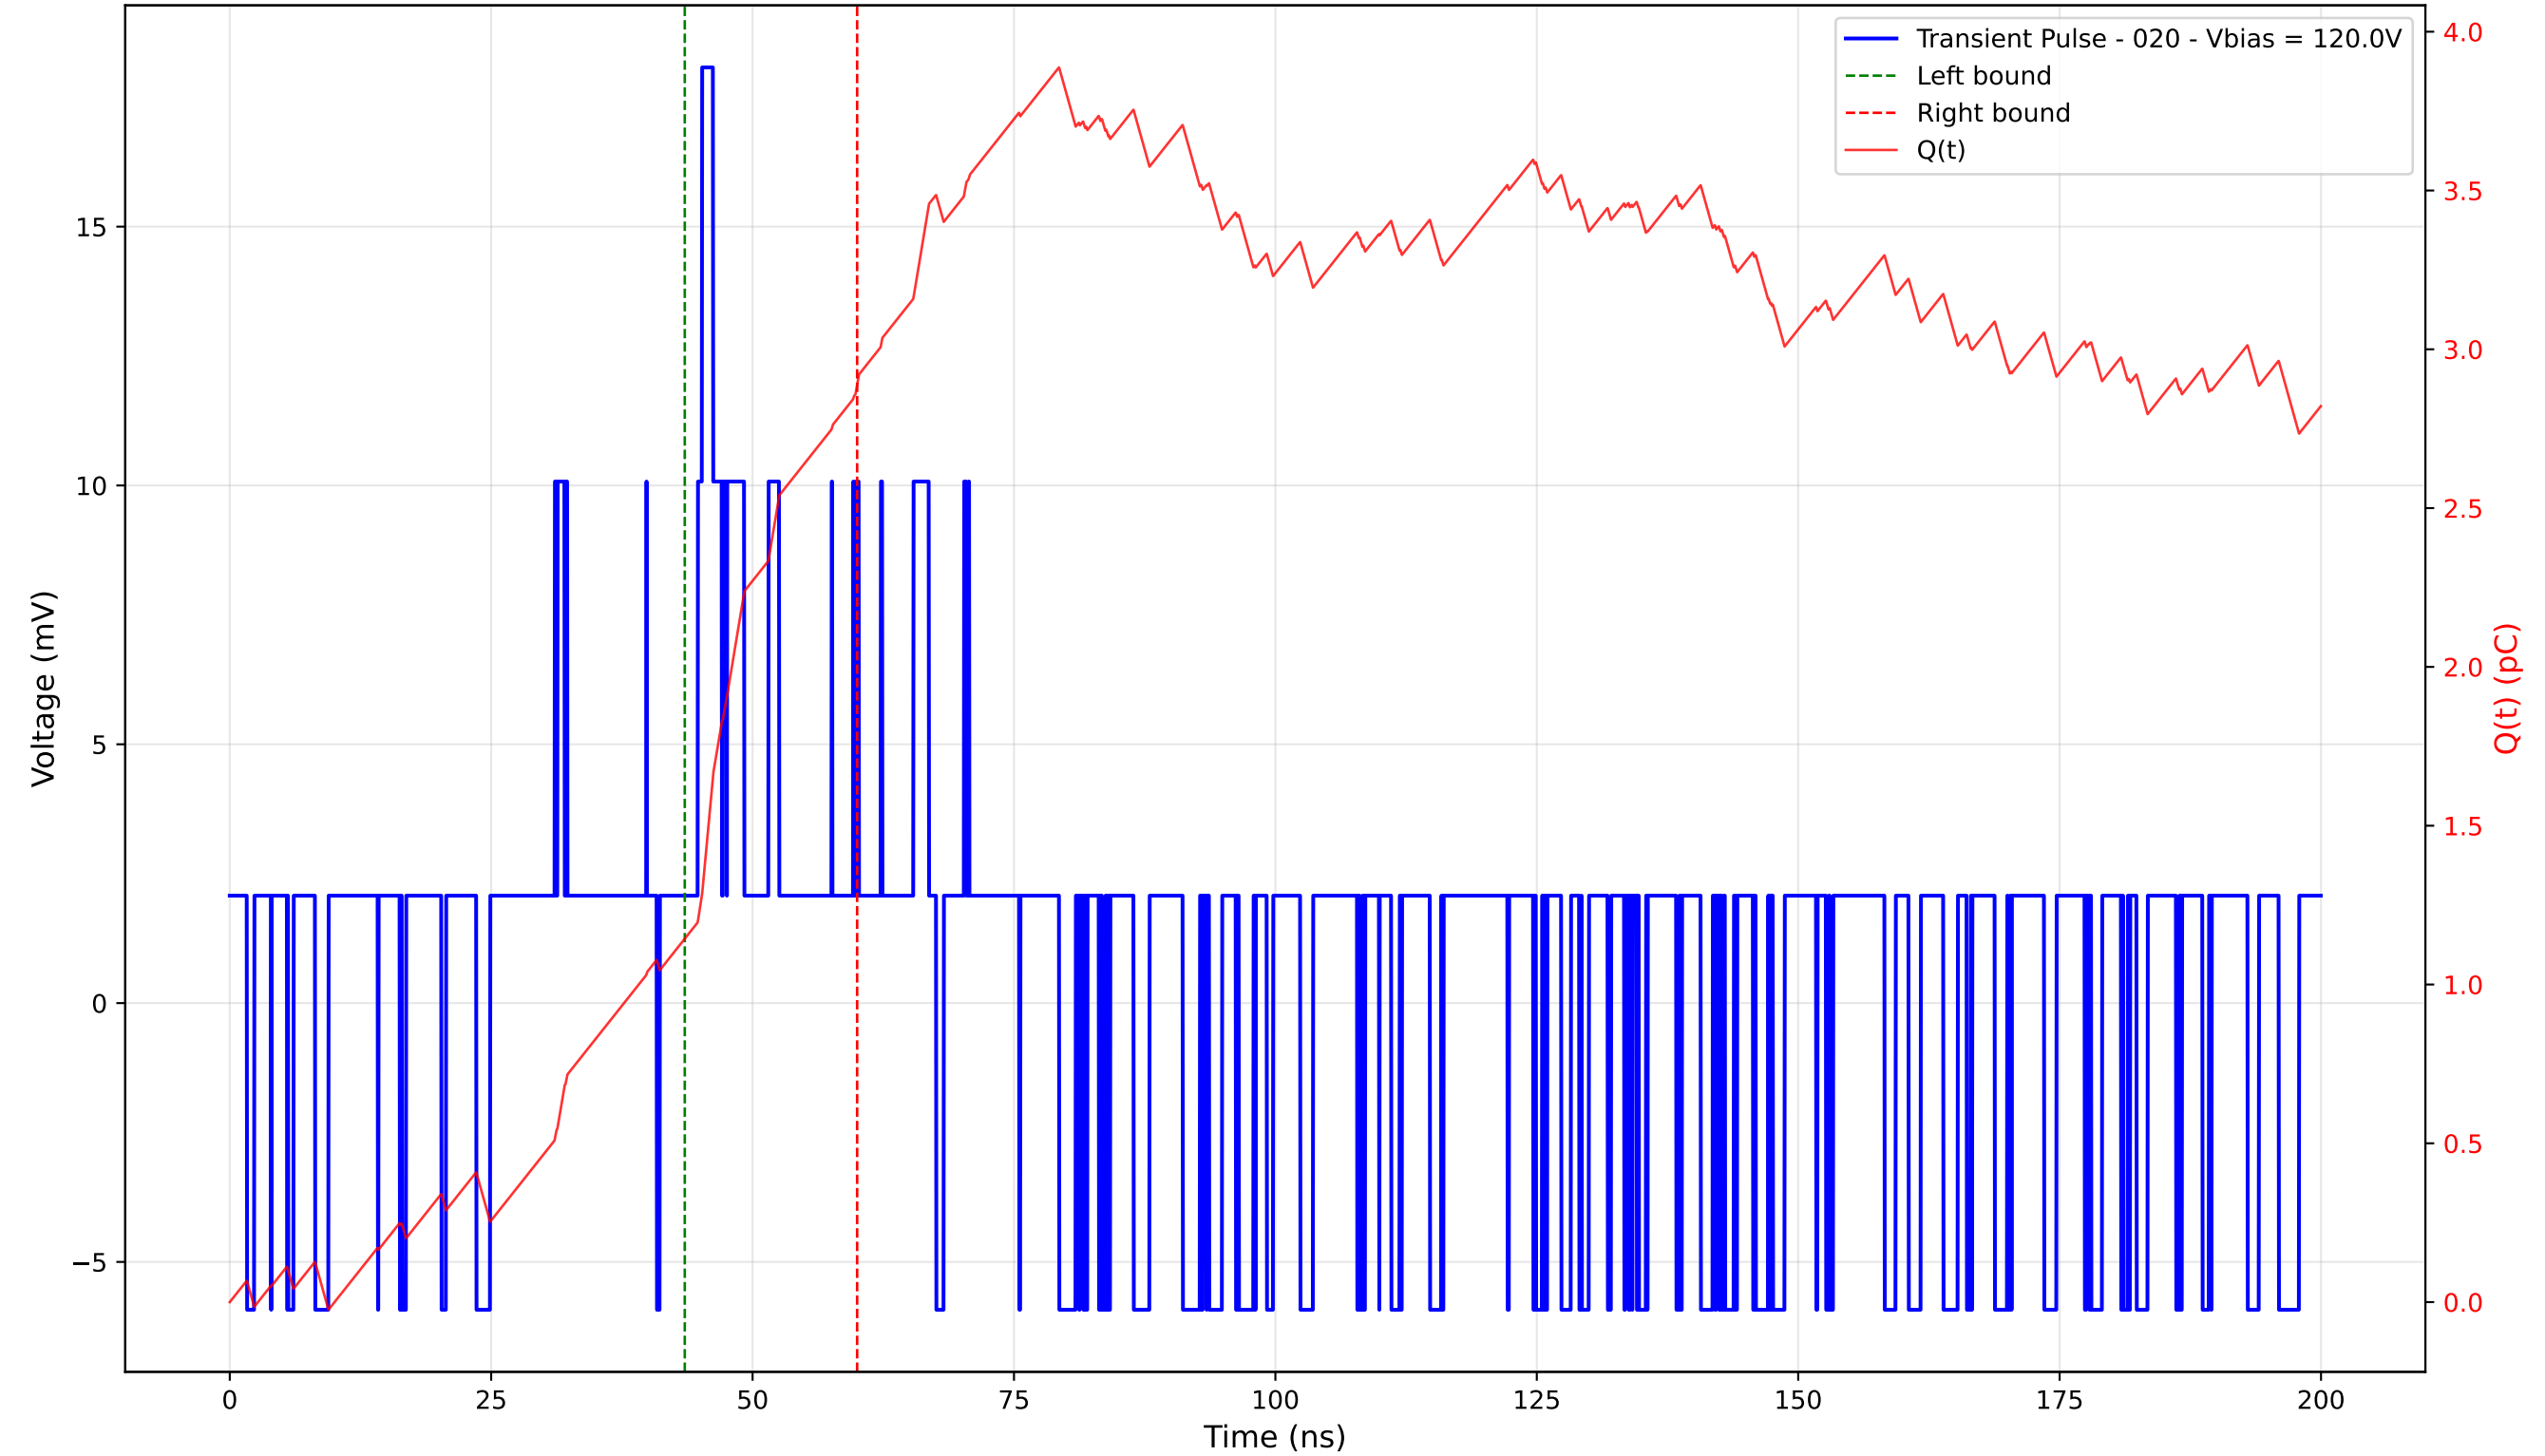


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.58 pC - Rise Time: 0.54 ns

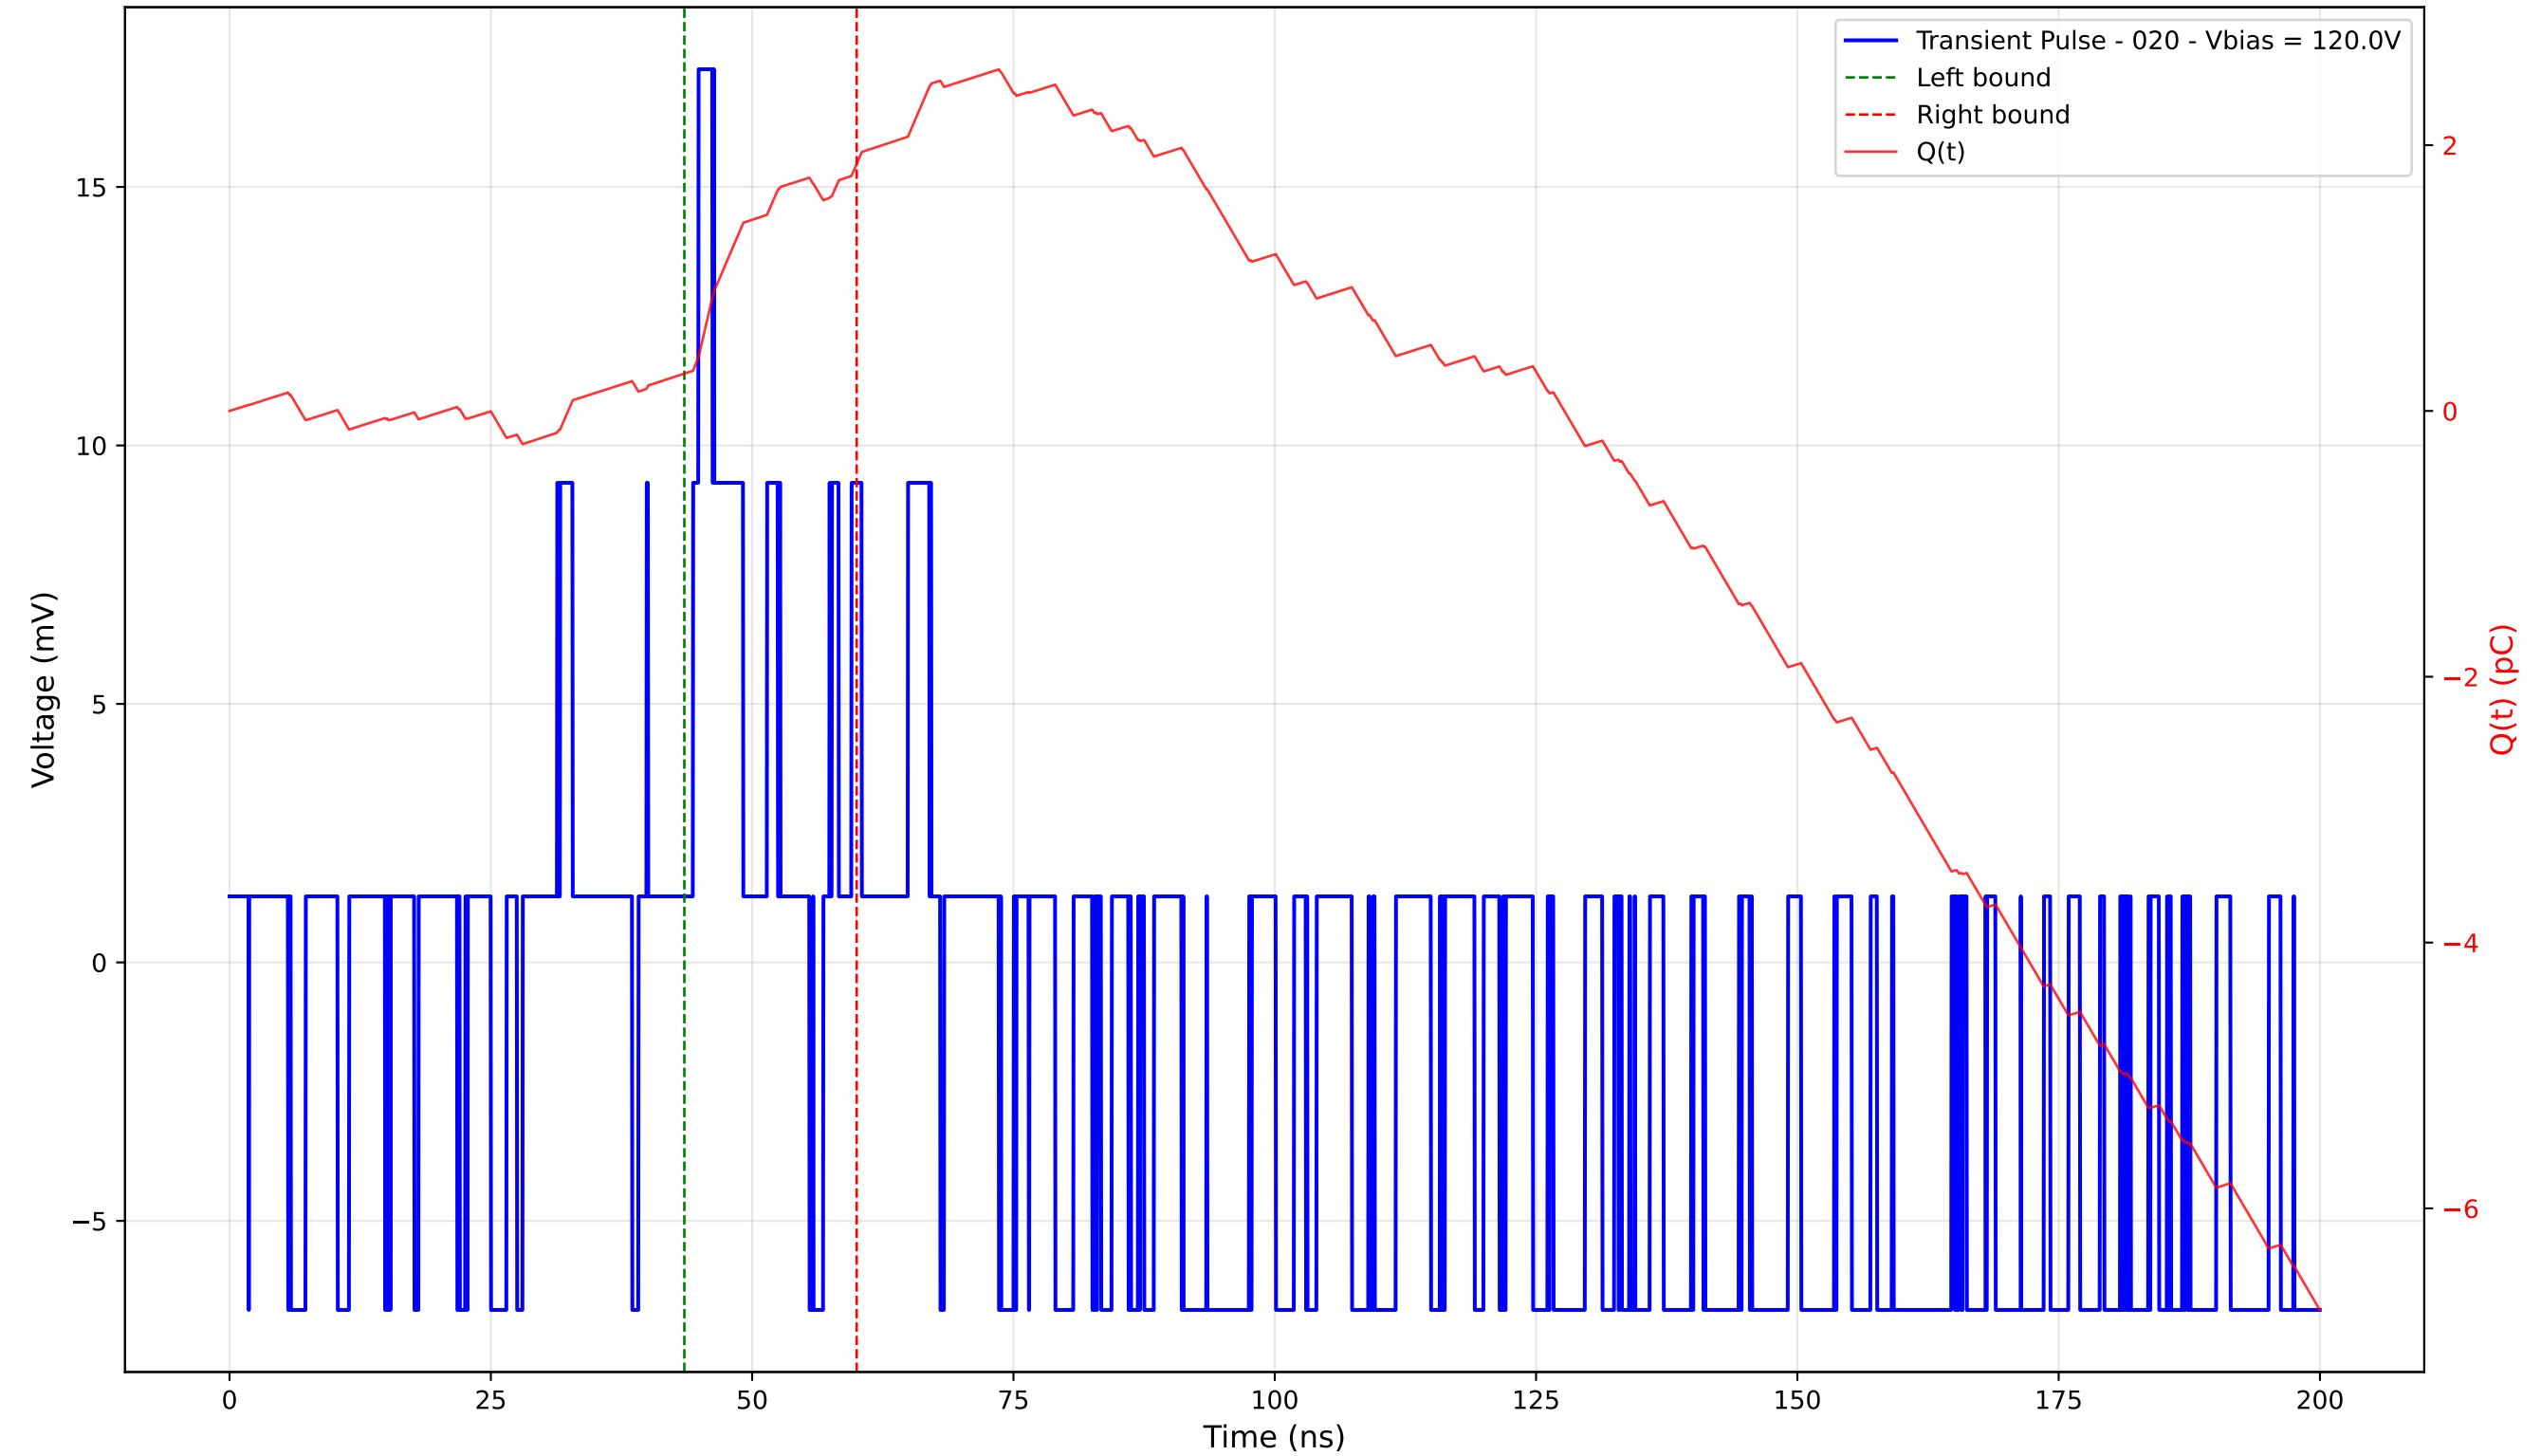


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 2.84 pC - Rise Time: 0.00 ns (N/A)

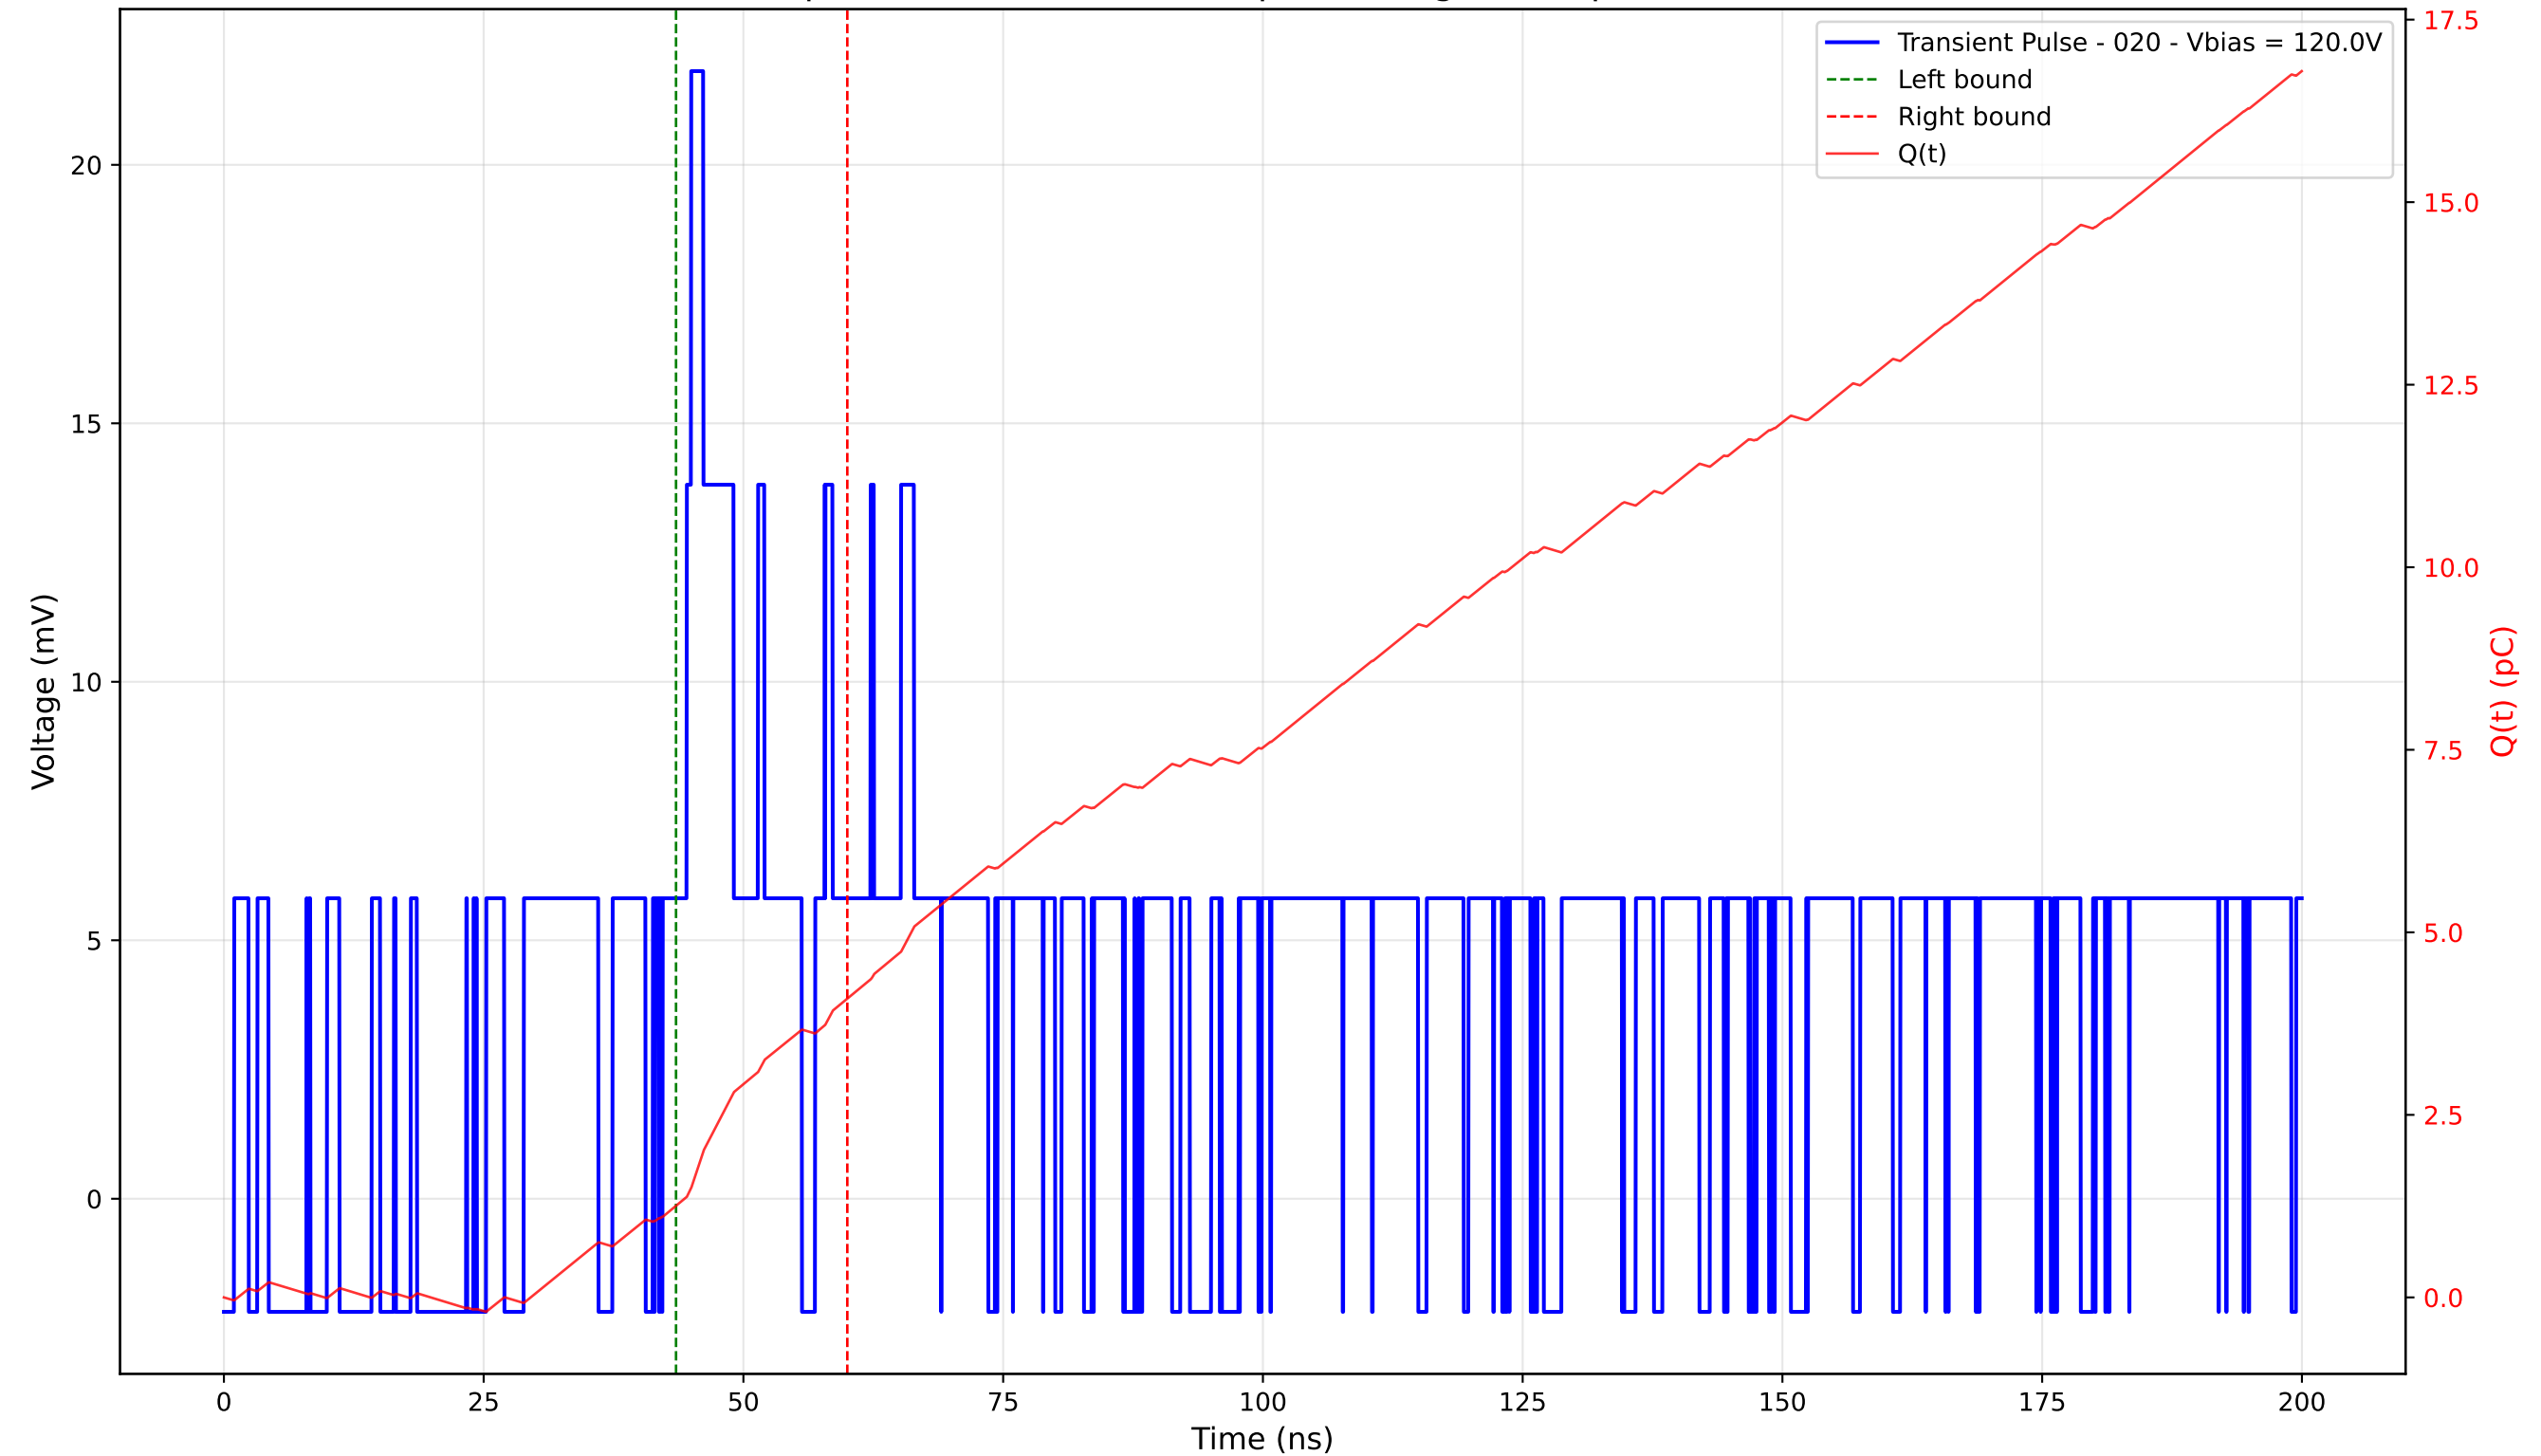


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 2.42 pC - Rise Time: 0.92 ns

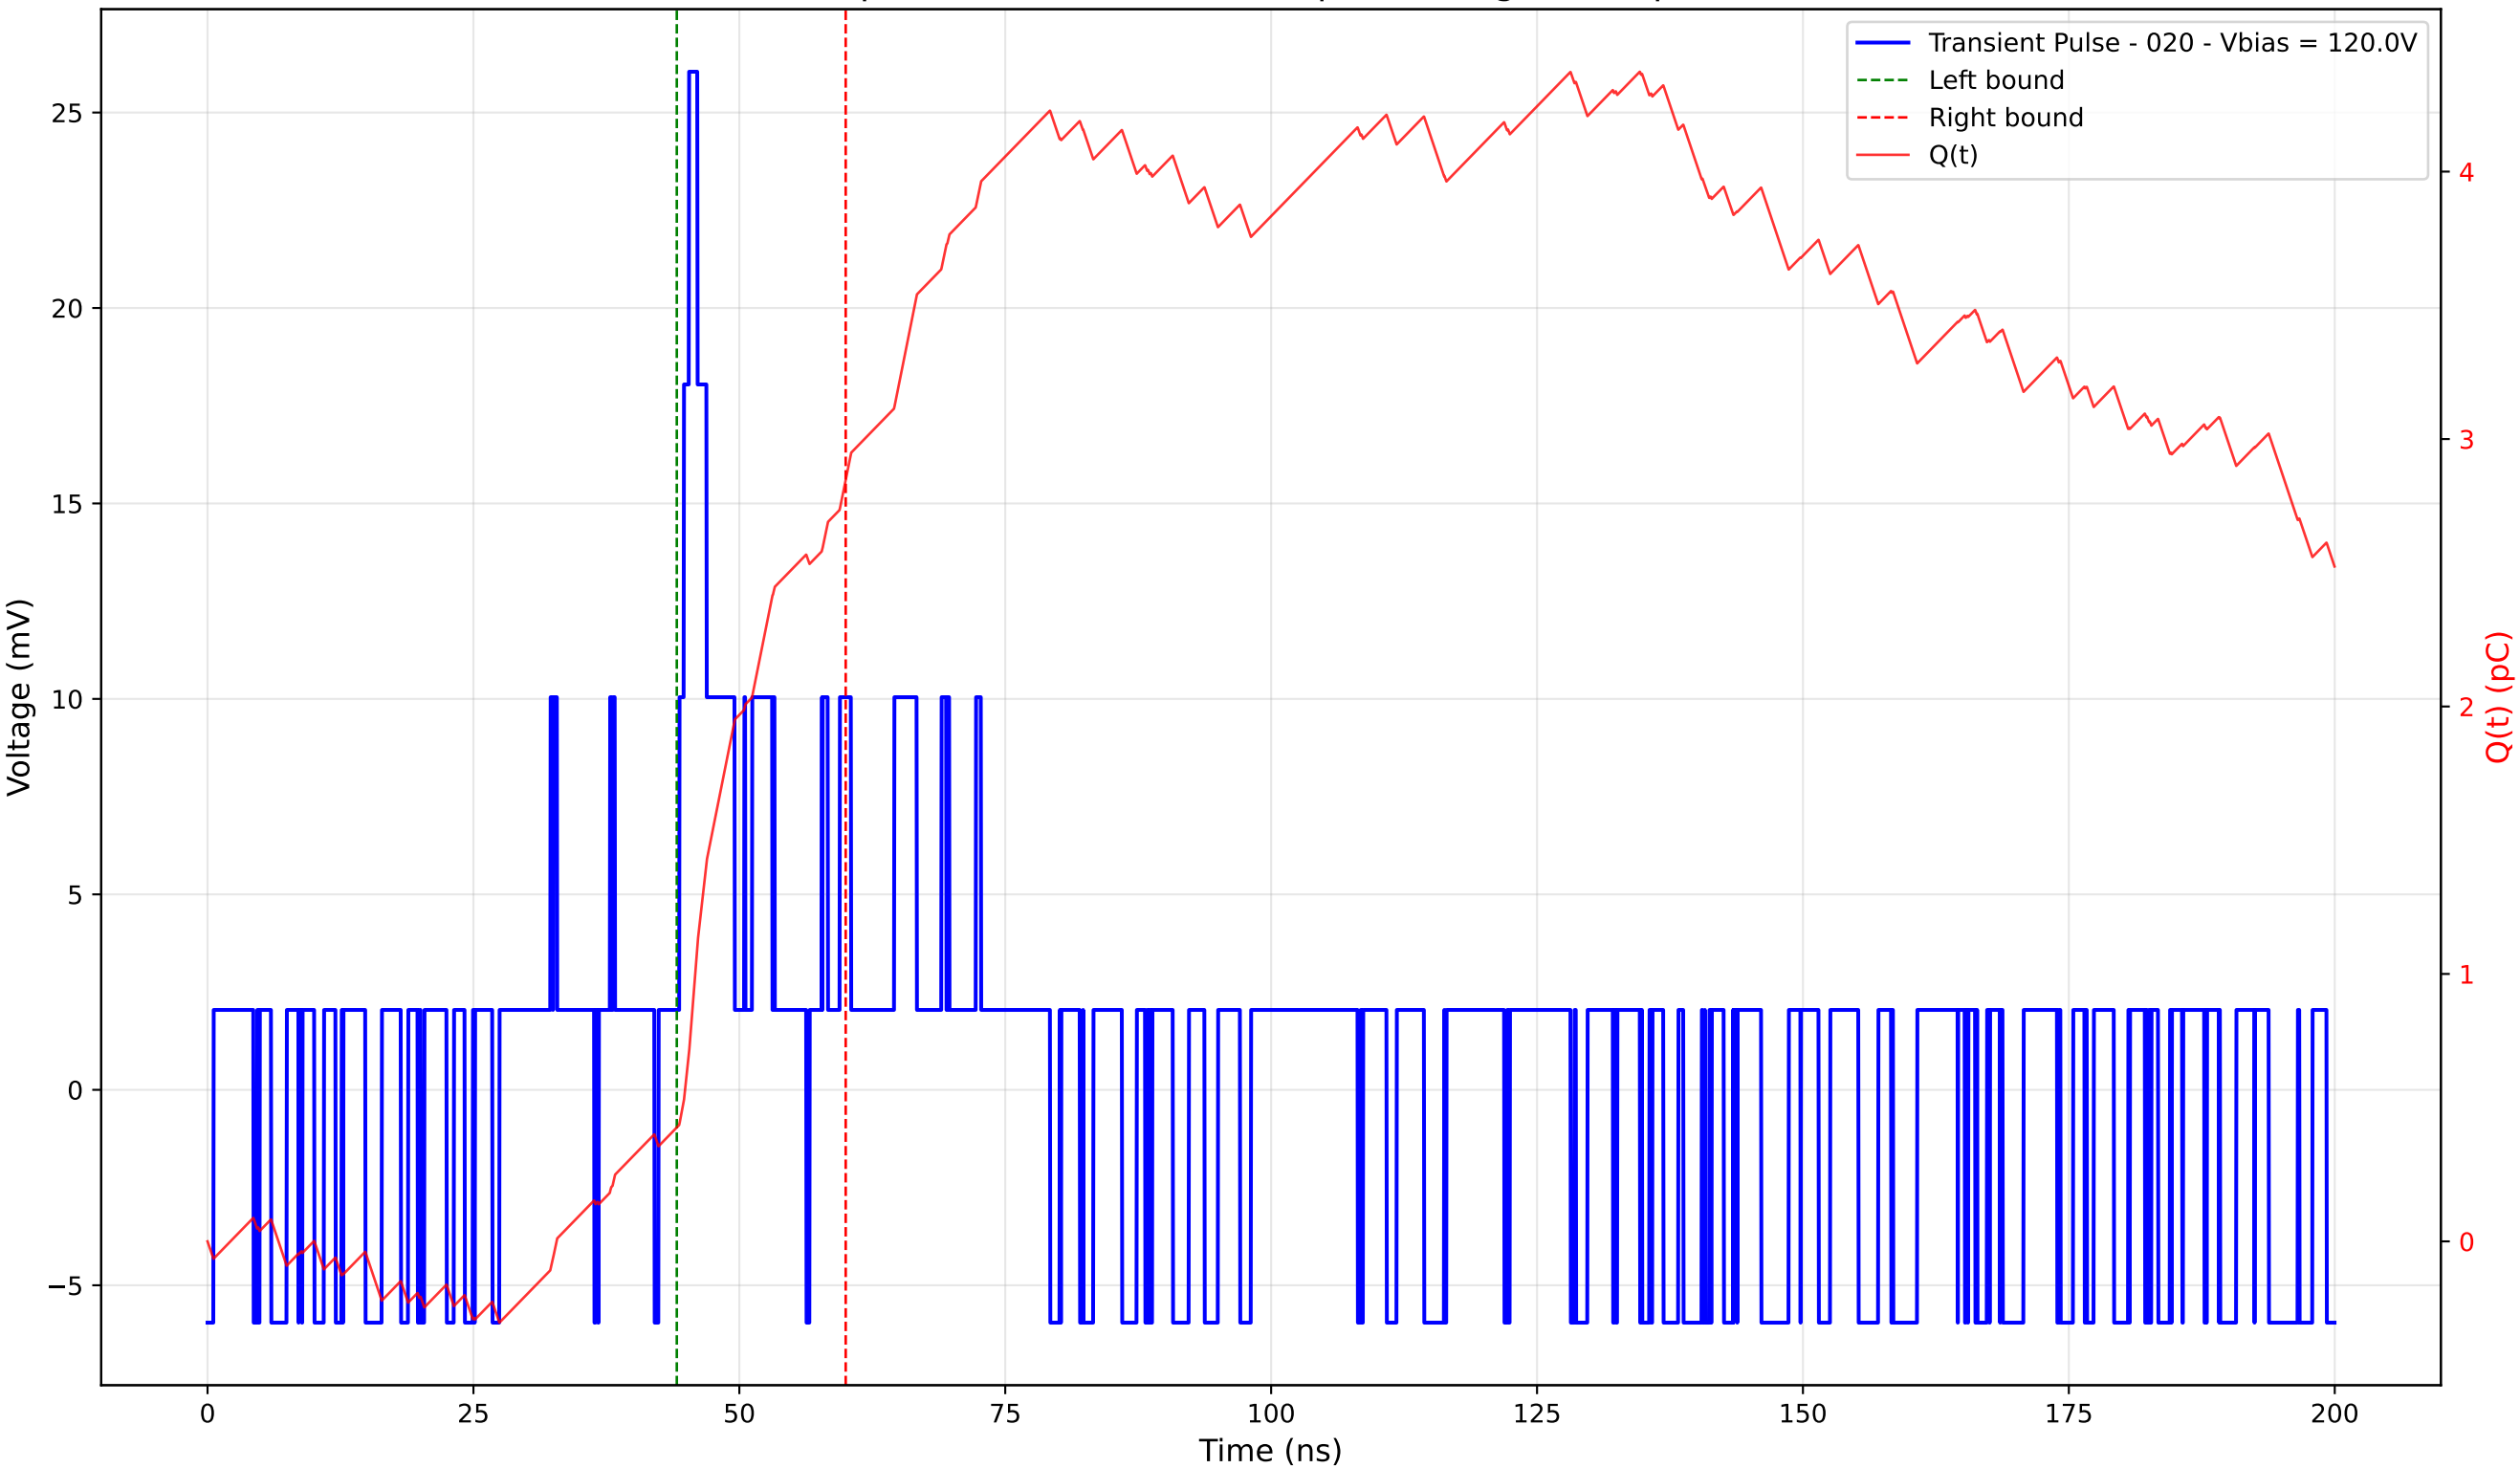


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 2.41 pC - Rise Time: 1.14 ns

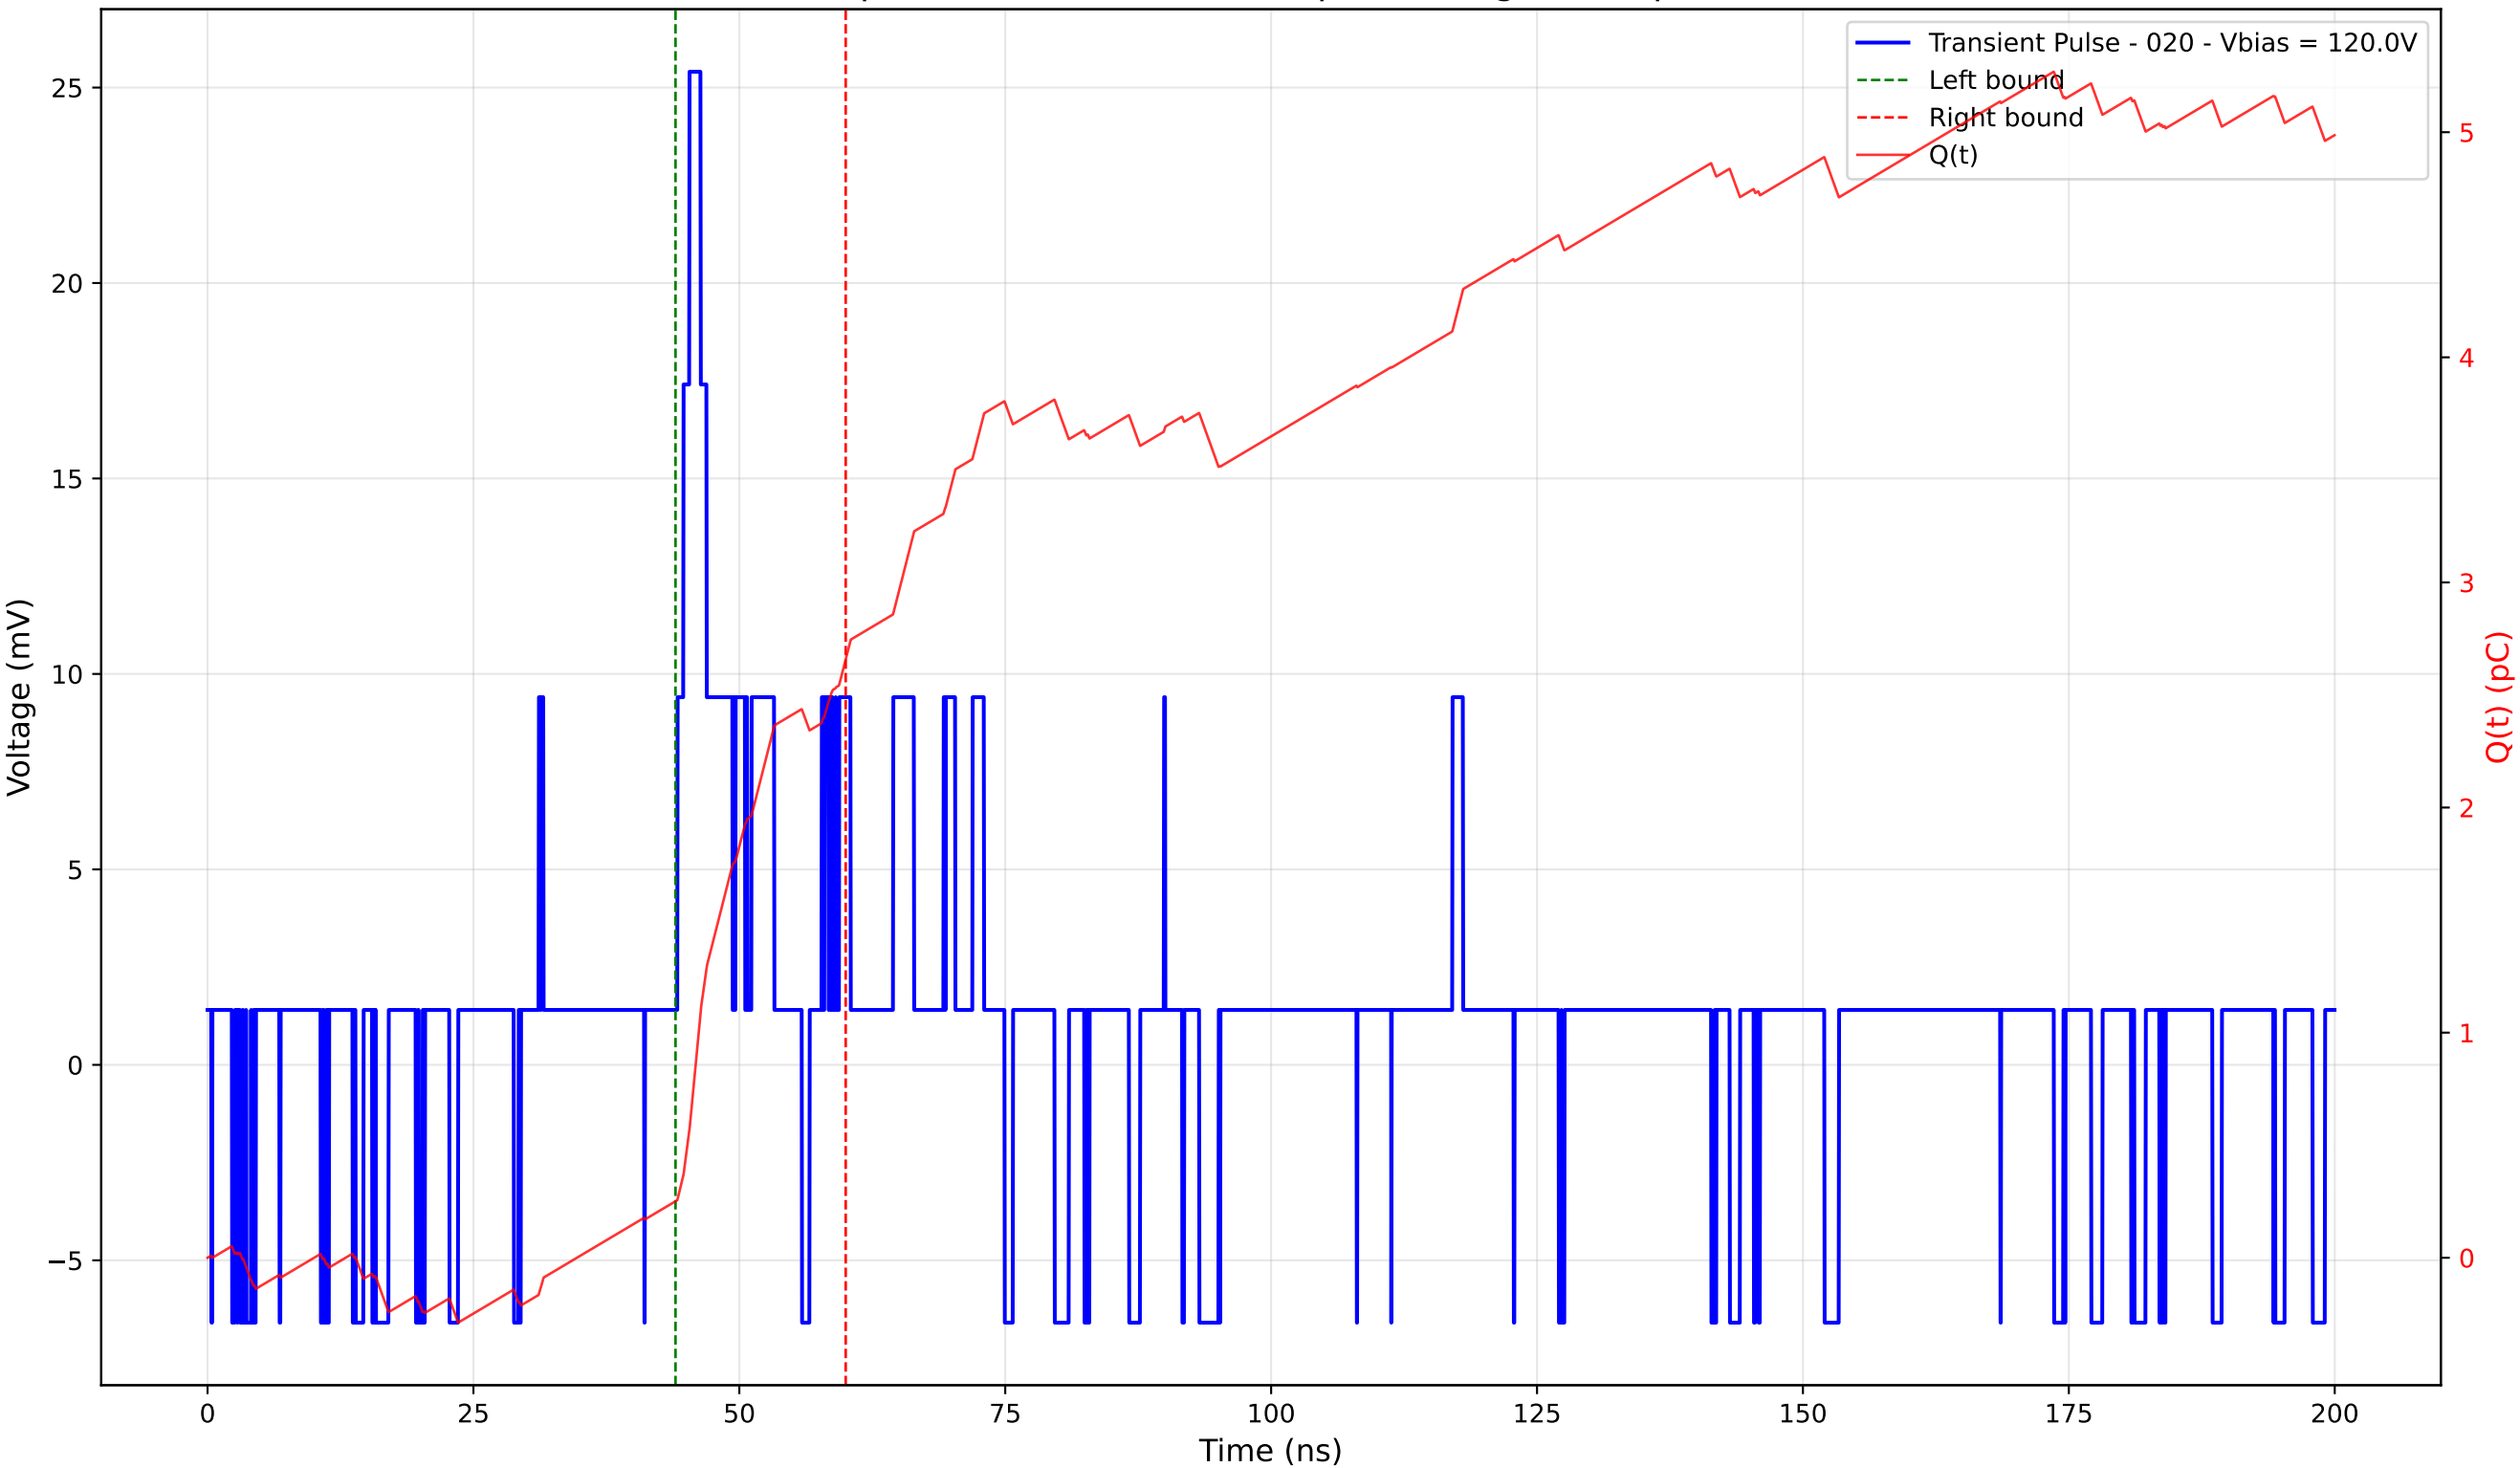


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 2.59 pC - Rise Time: 0.96 ns

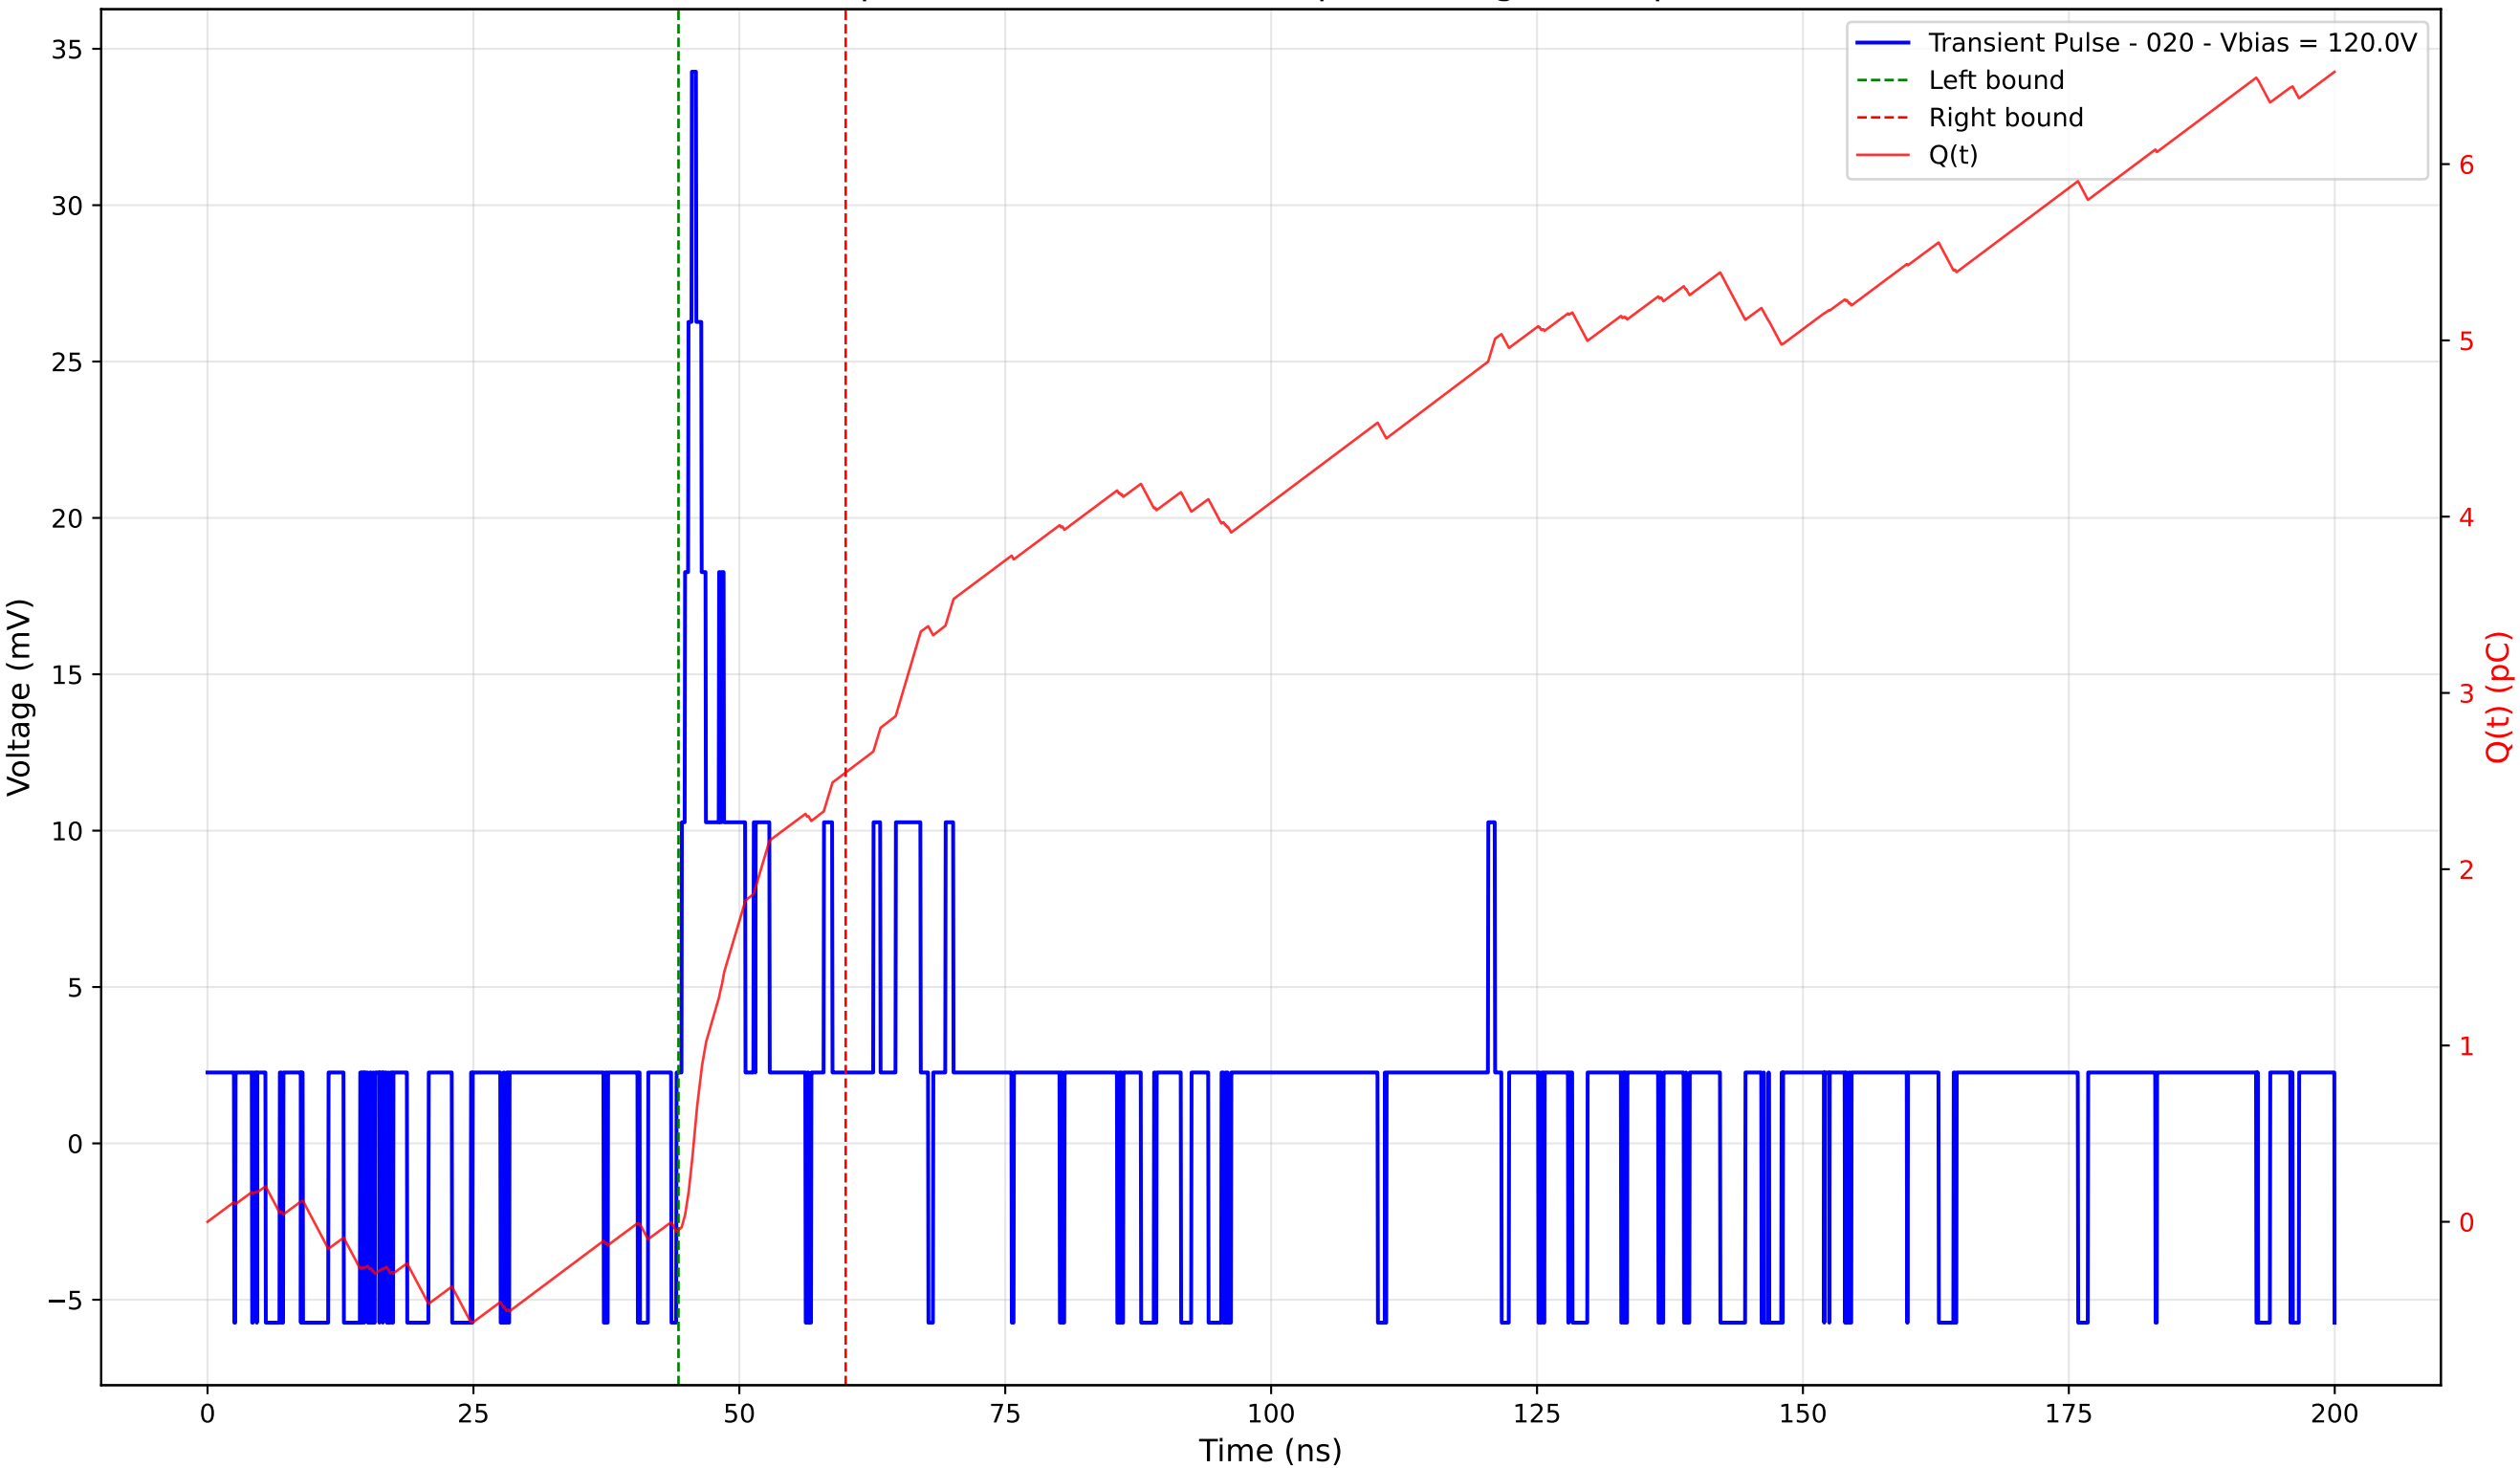


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.40 pC - Rise Time: 0.00 ns (N/A)

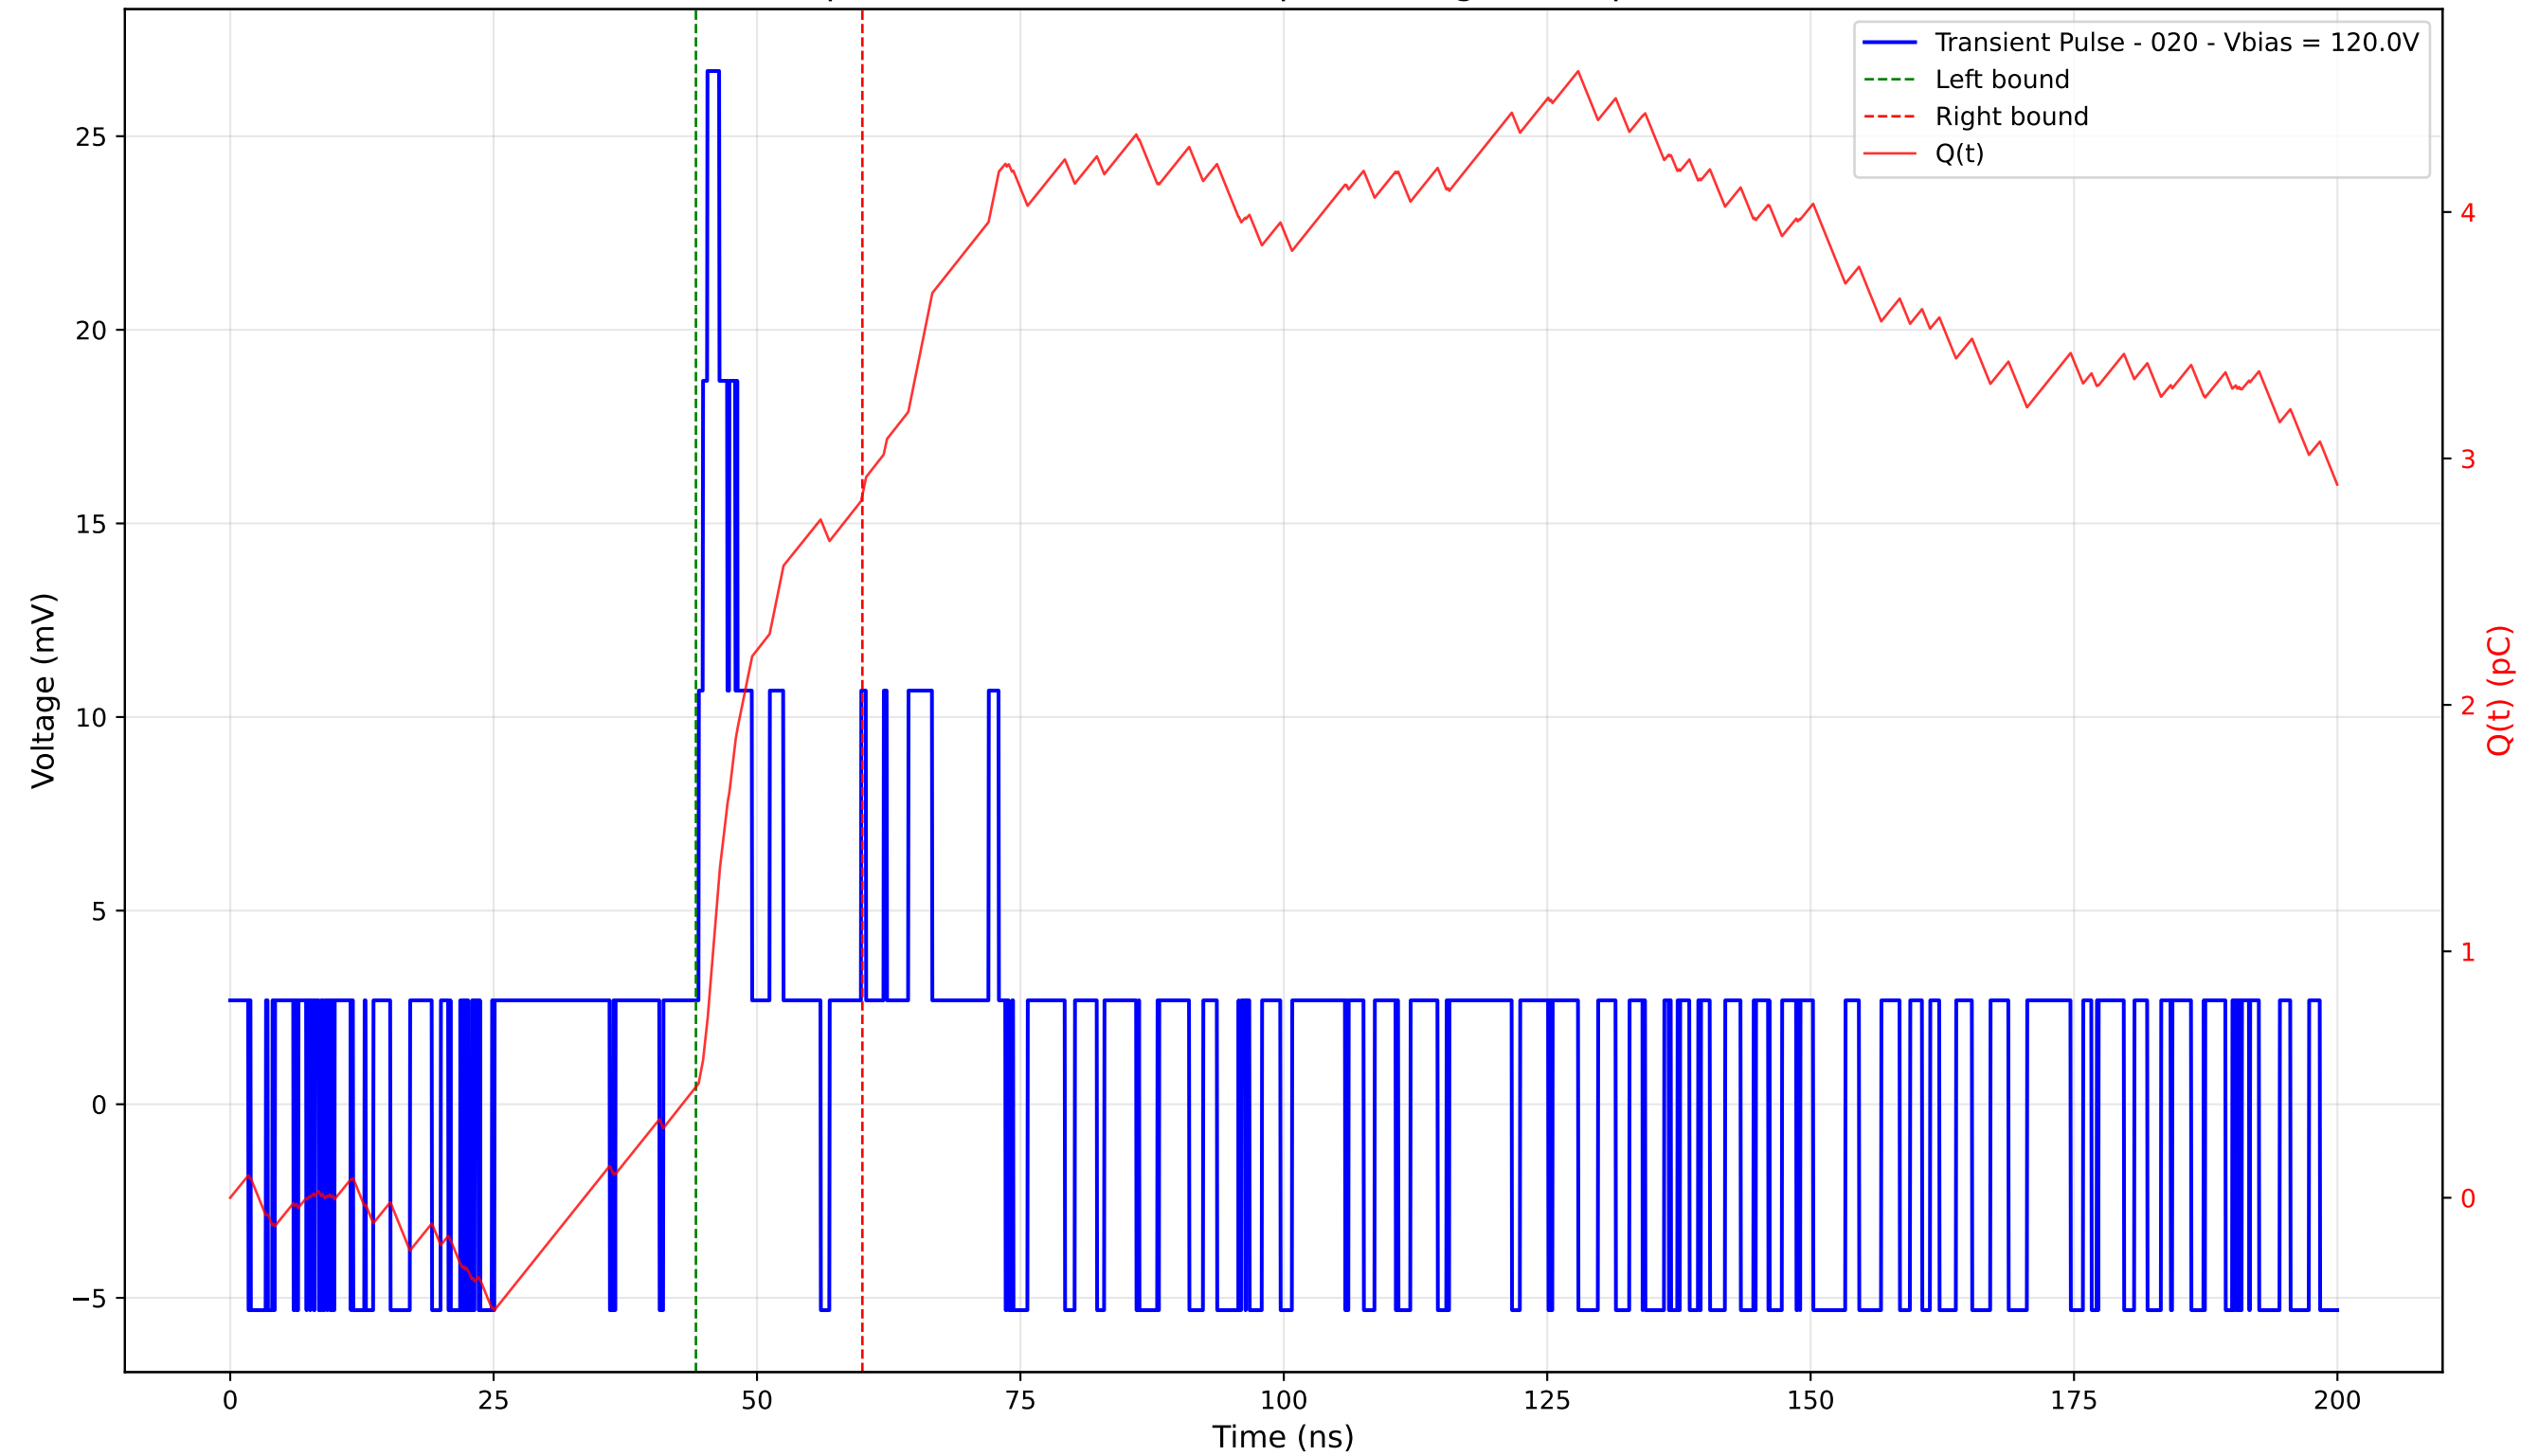


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 3.31 pC - Rise Time: 1.03 ns

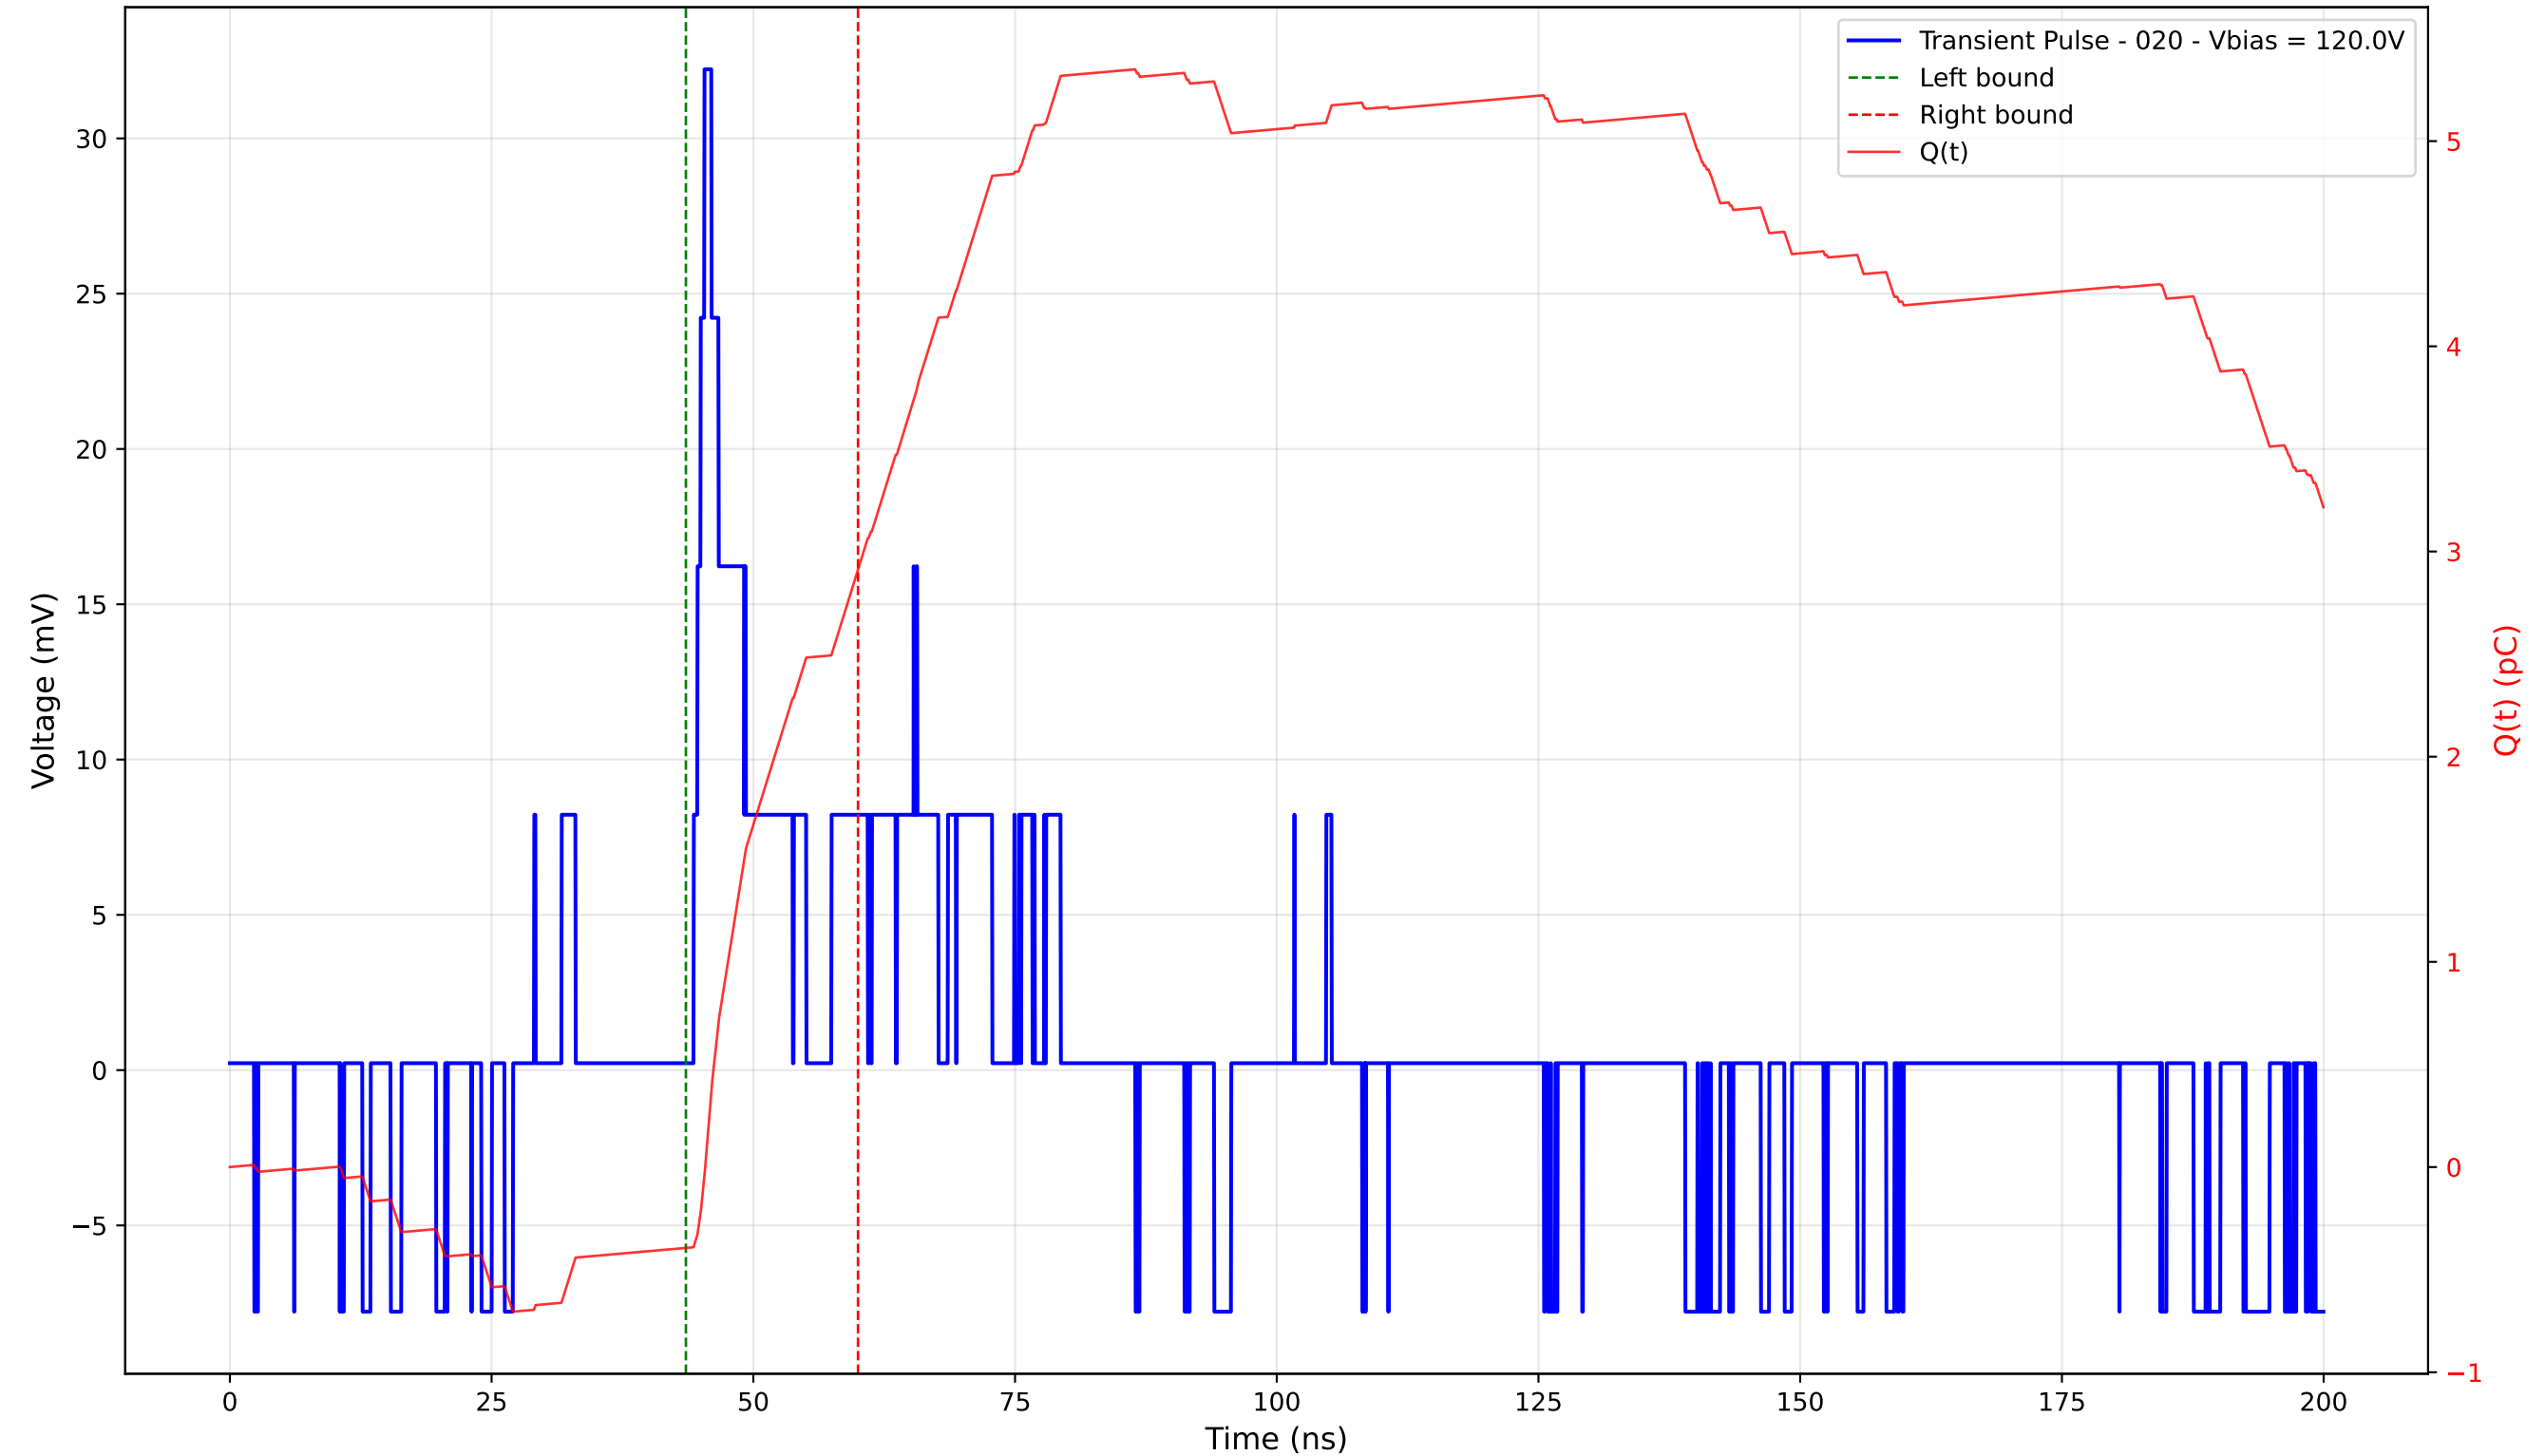


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 4.52 pC - Rise Time: 1.00 ns

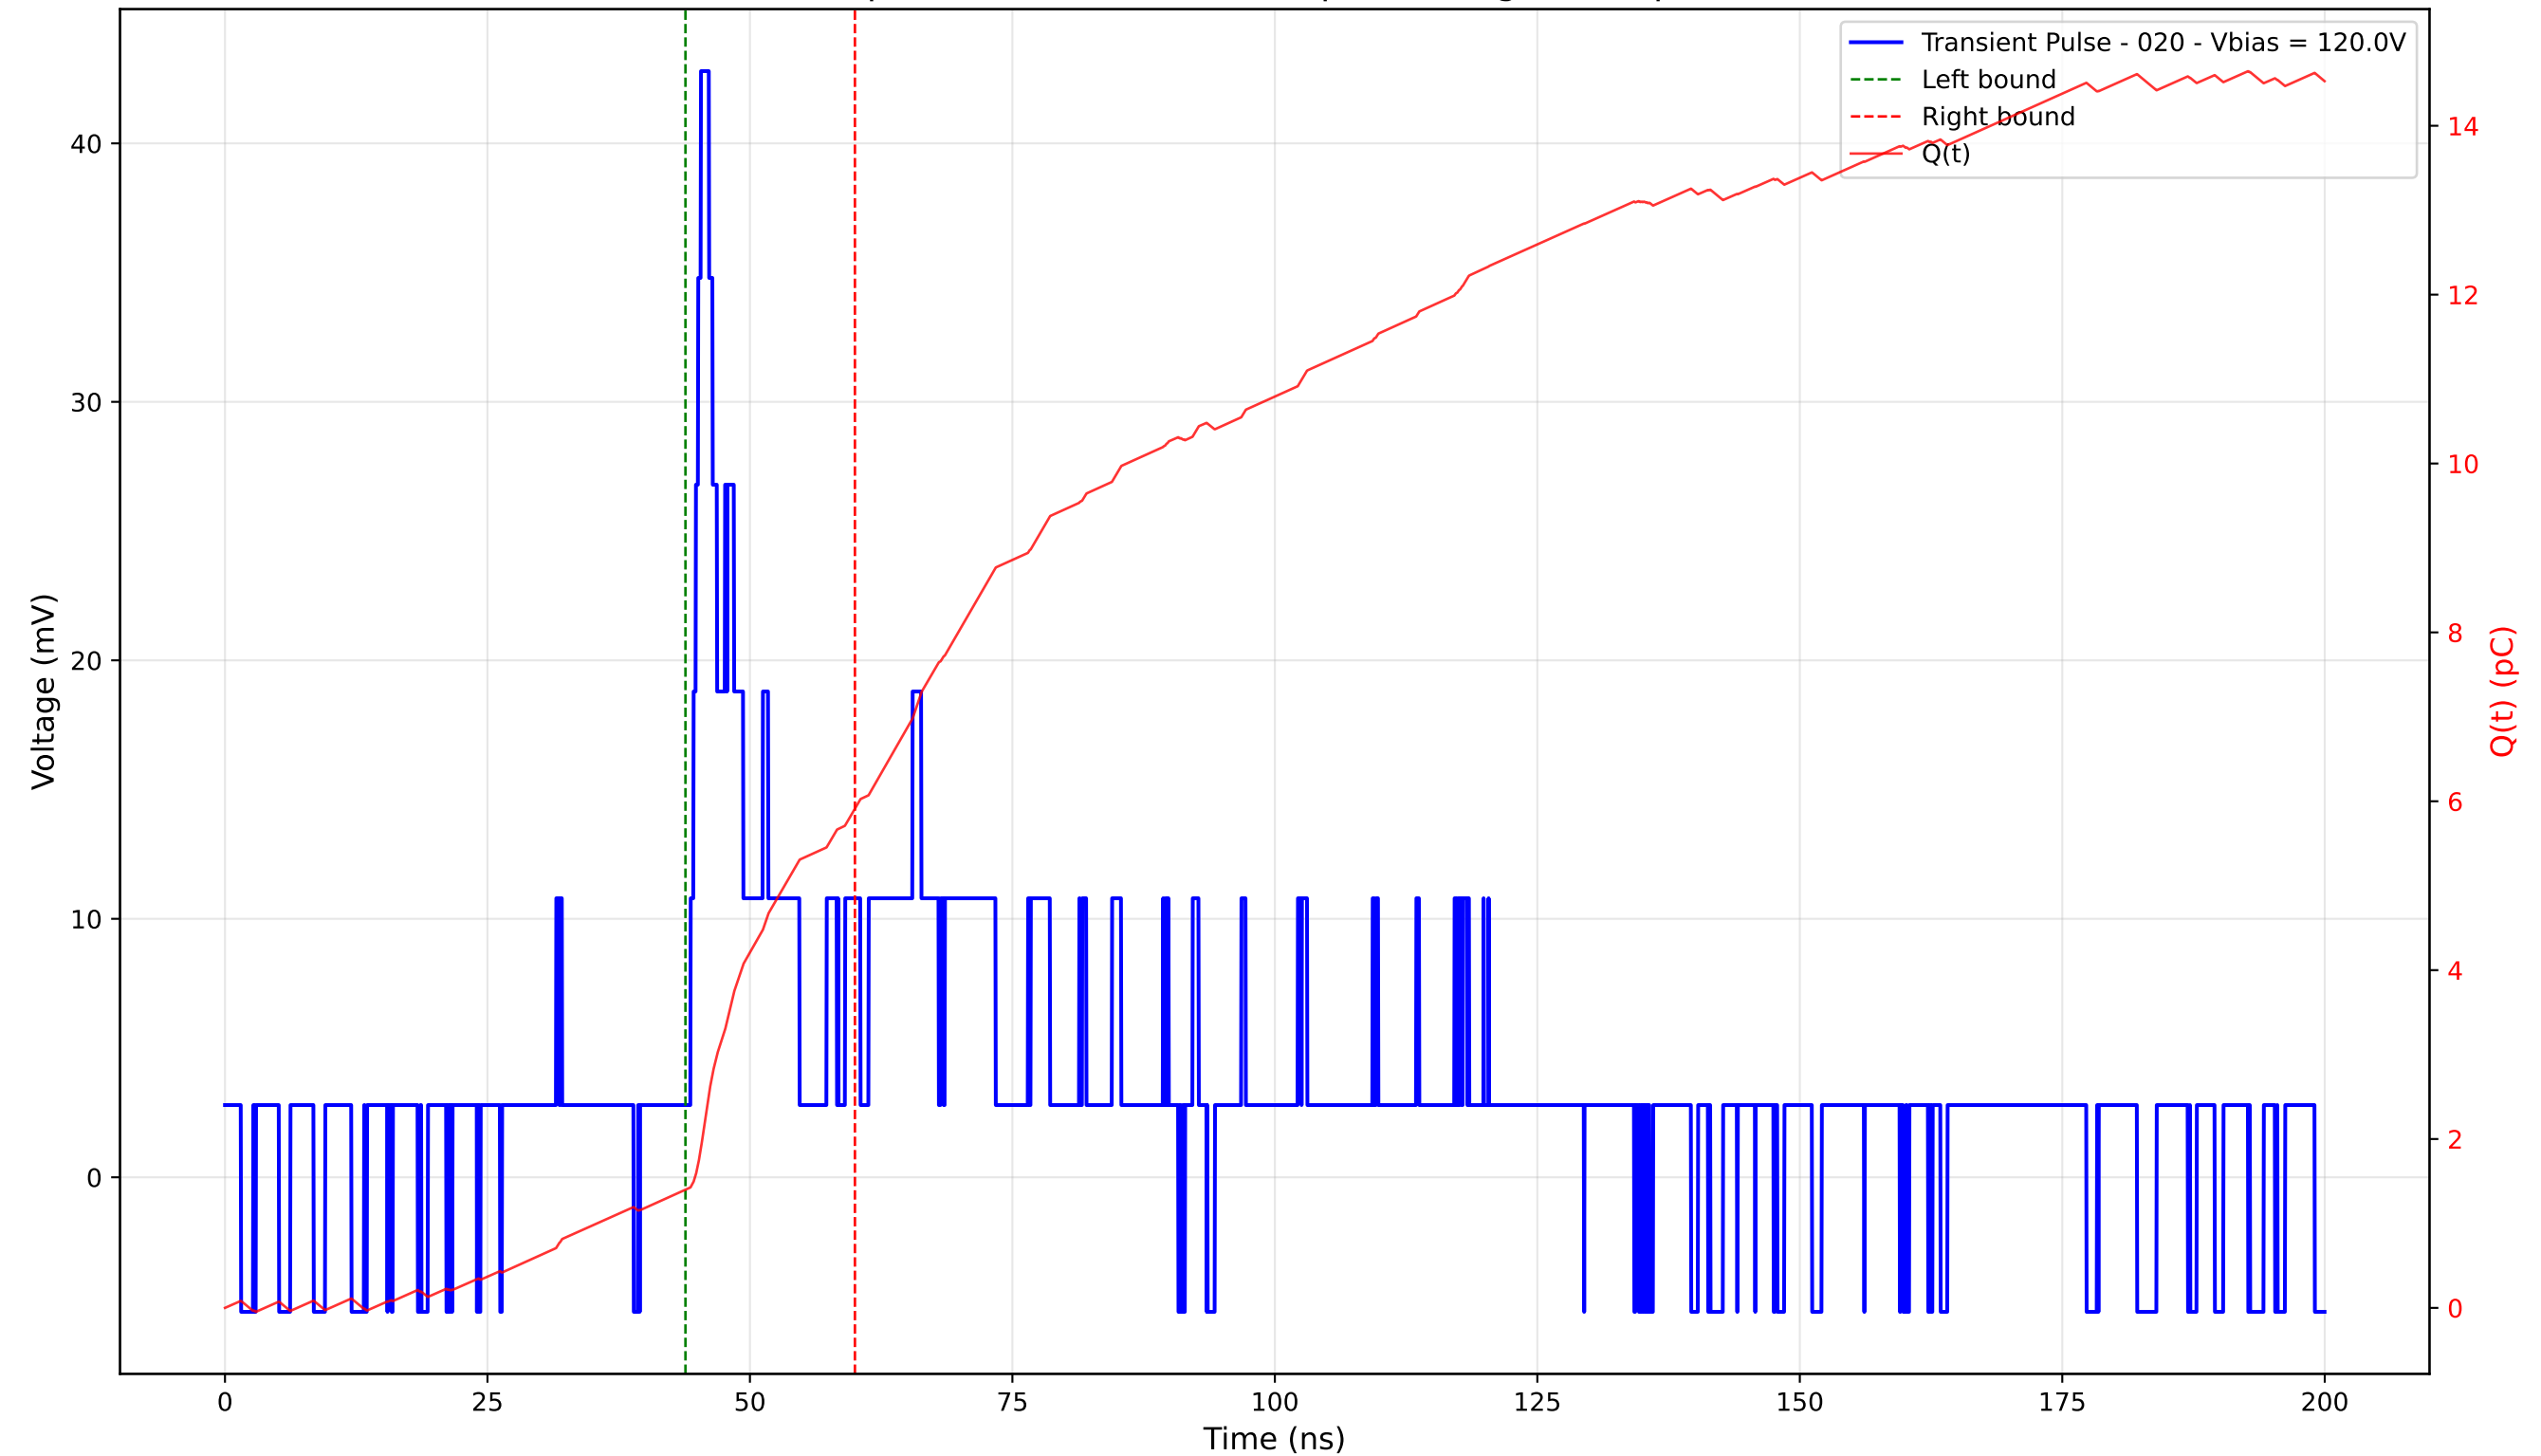


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 4.85 pC - Rise Time: 15.58 ns

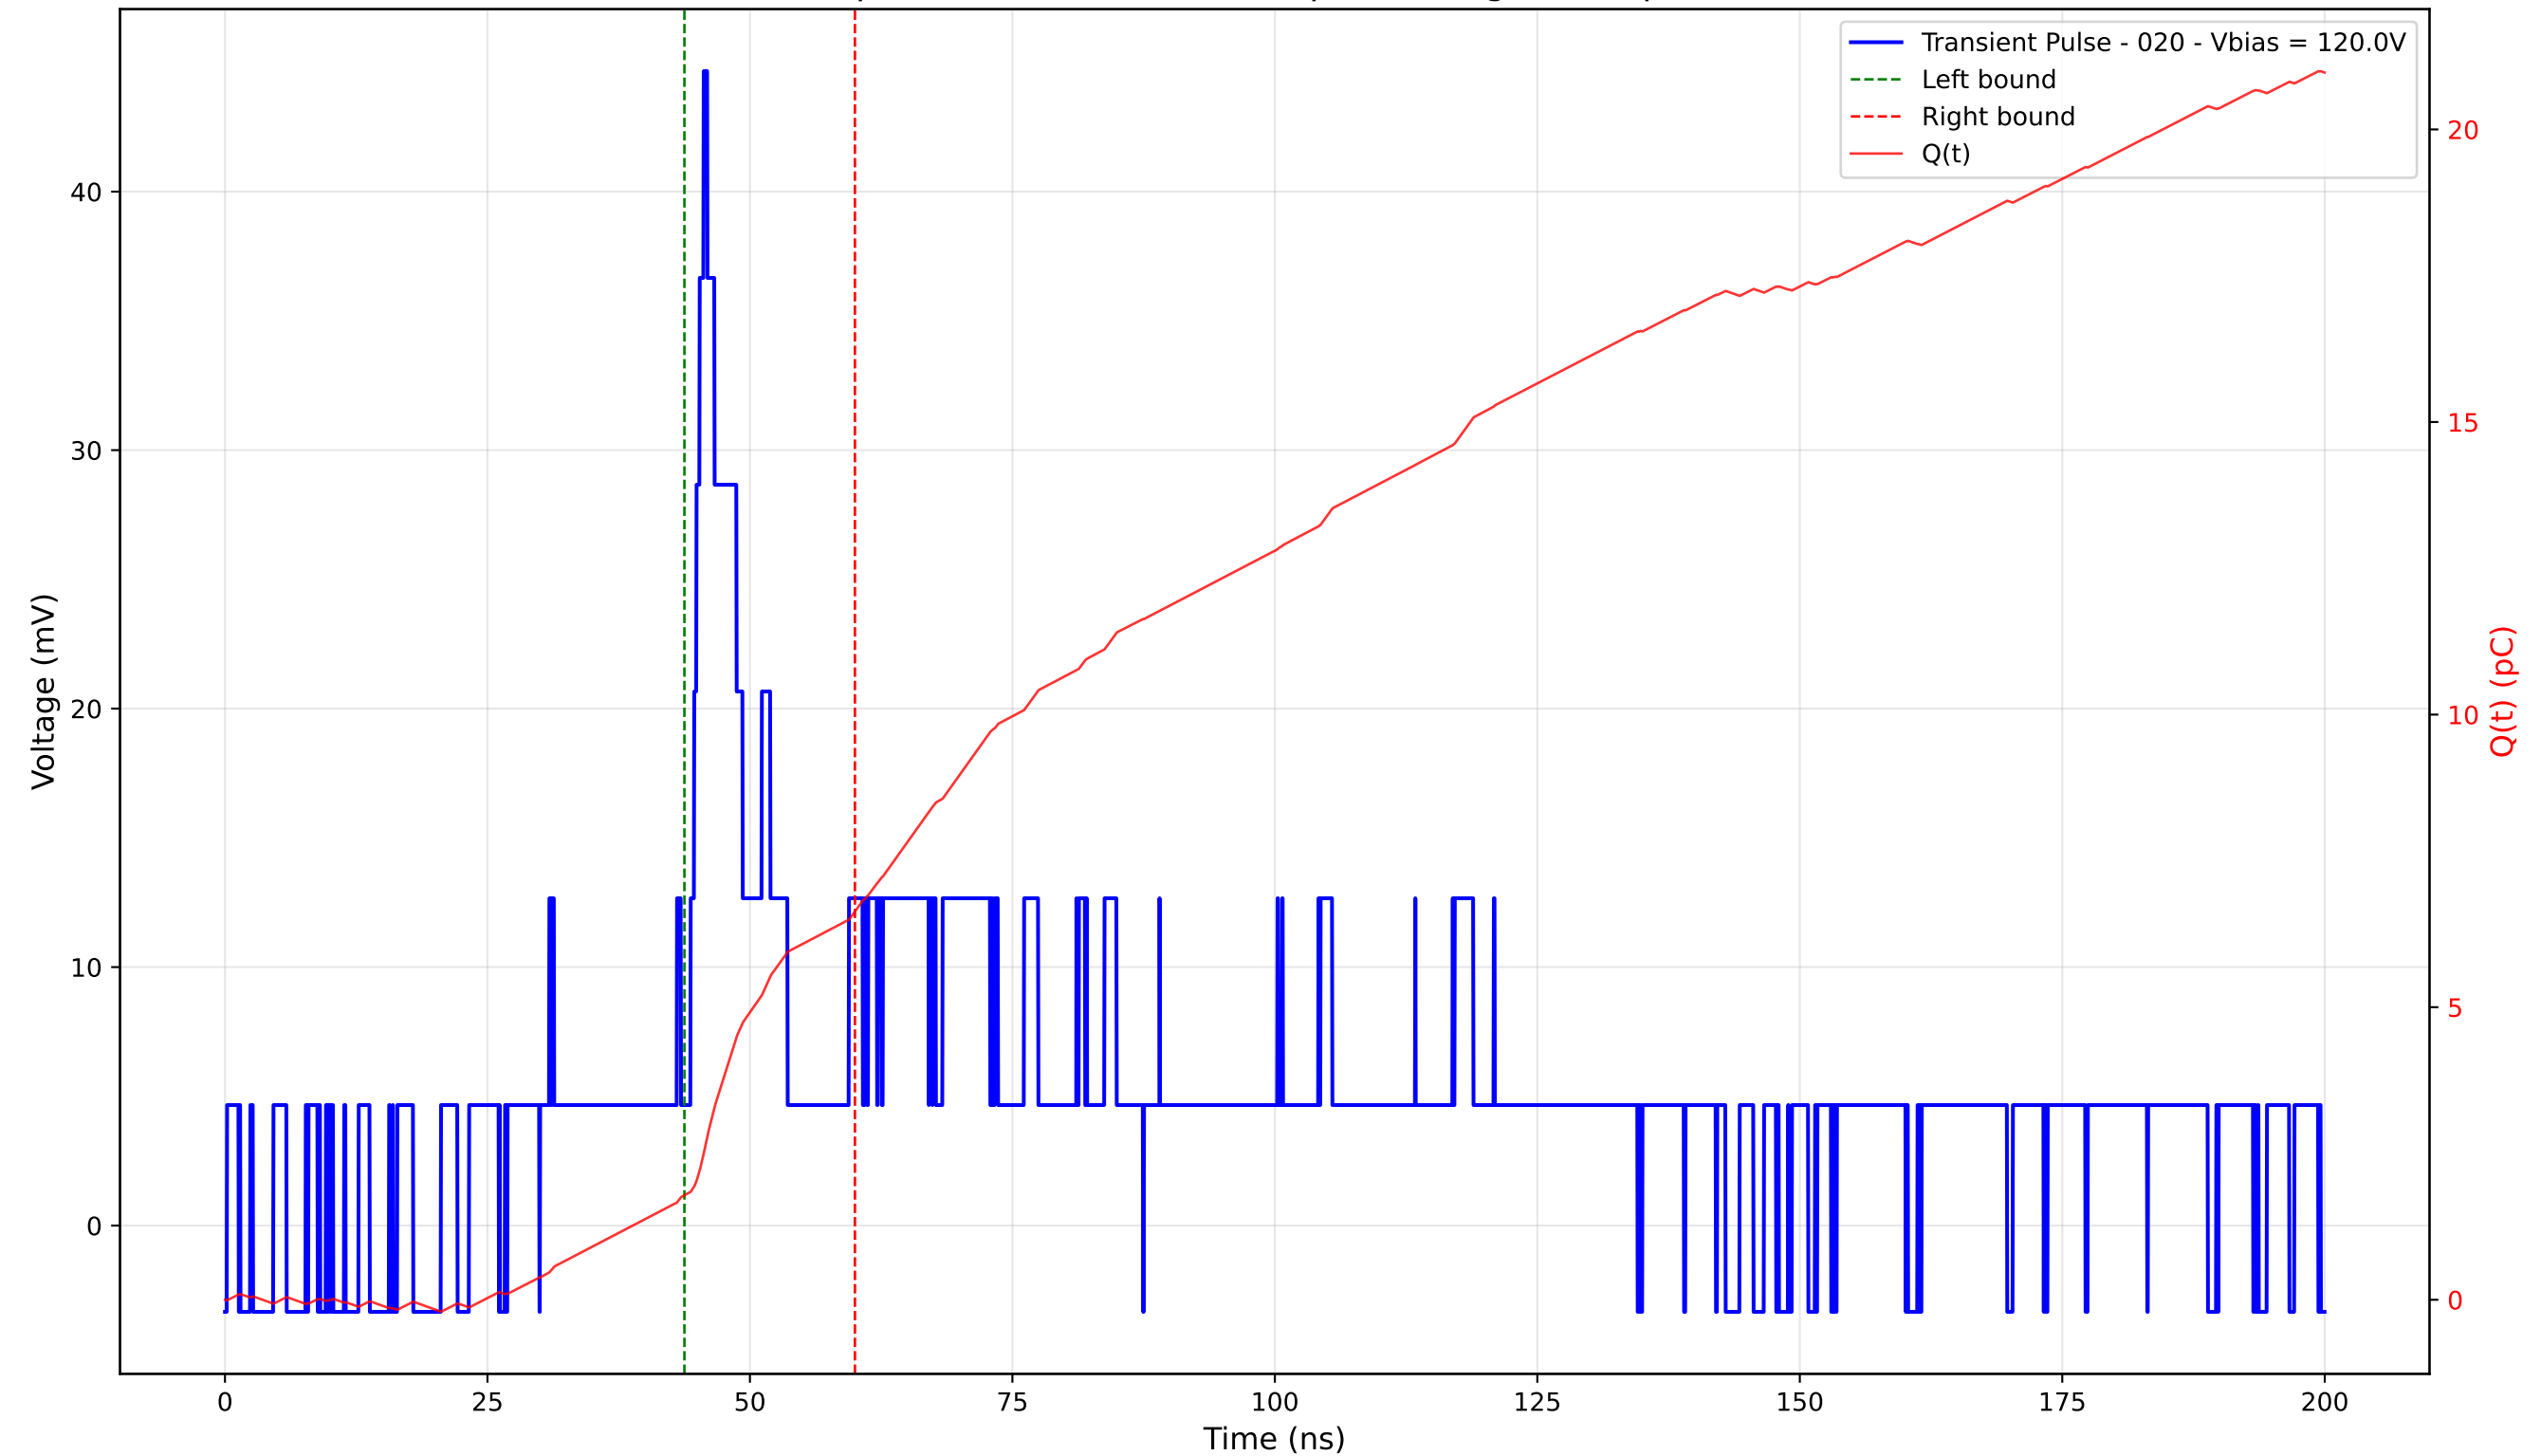


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 4.13 pC - Rise Time: 0.93 ns

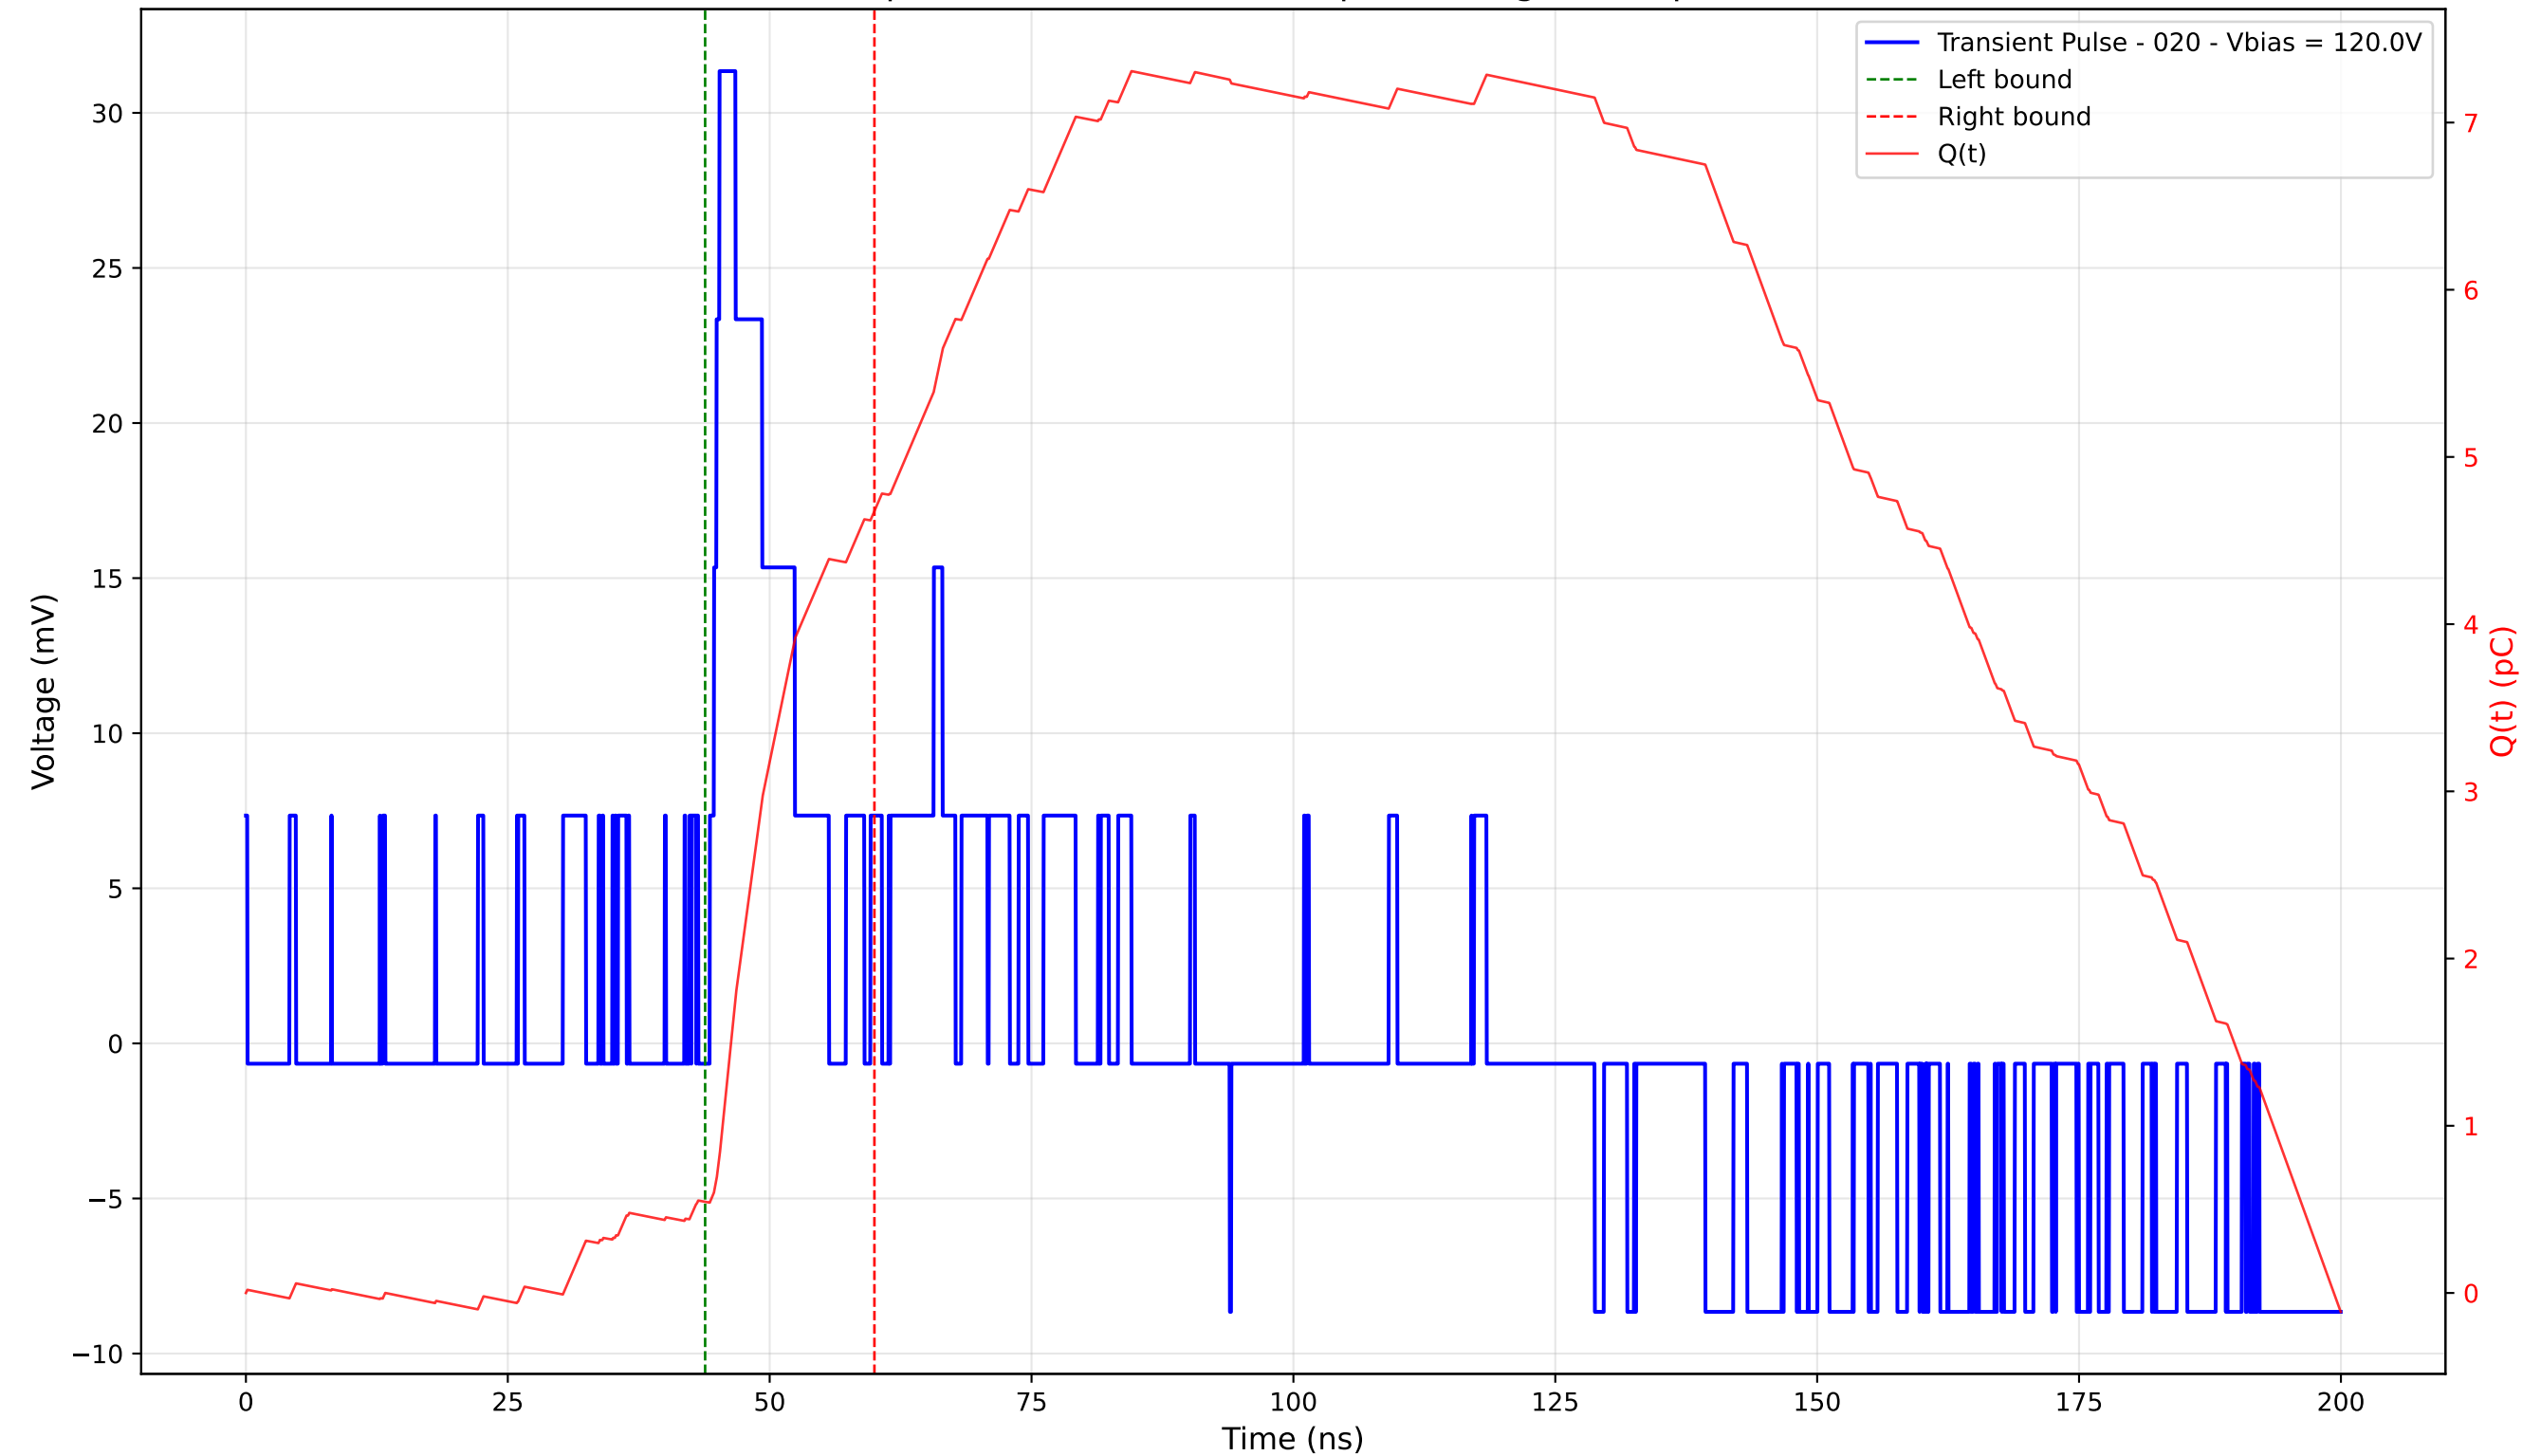


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 3.37 pC - Rise Time: 0.00 ns (N/A)

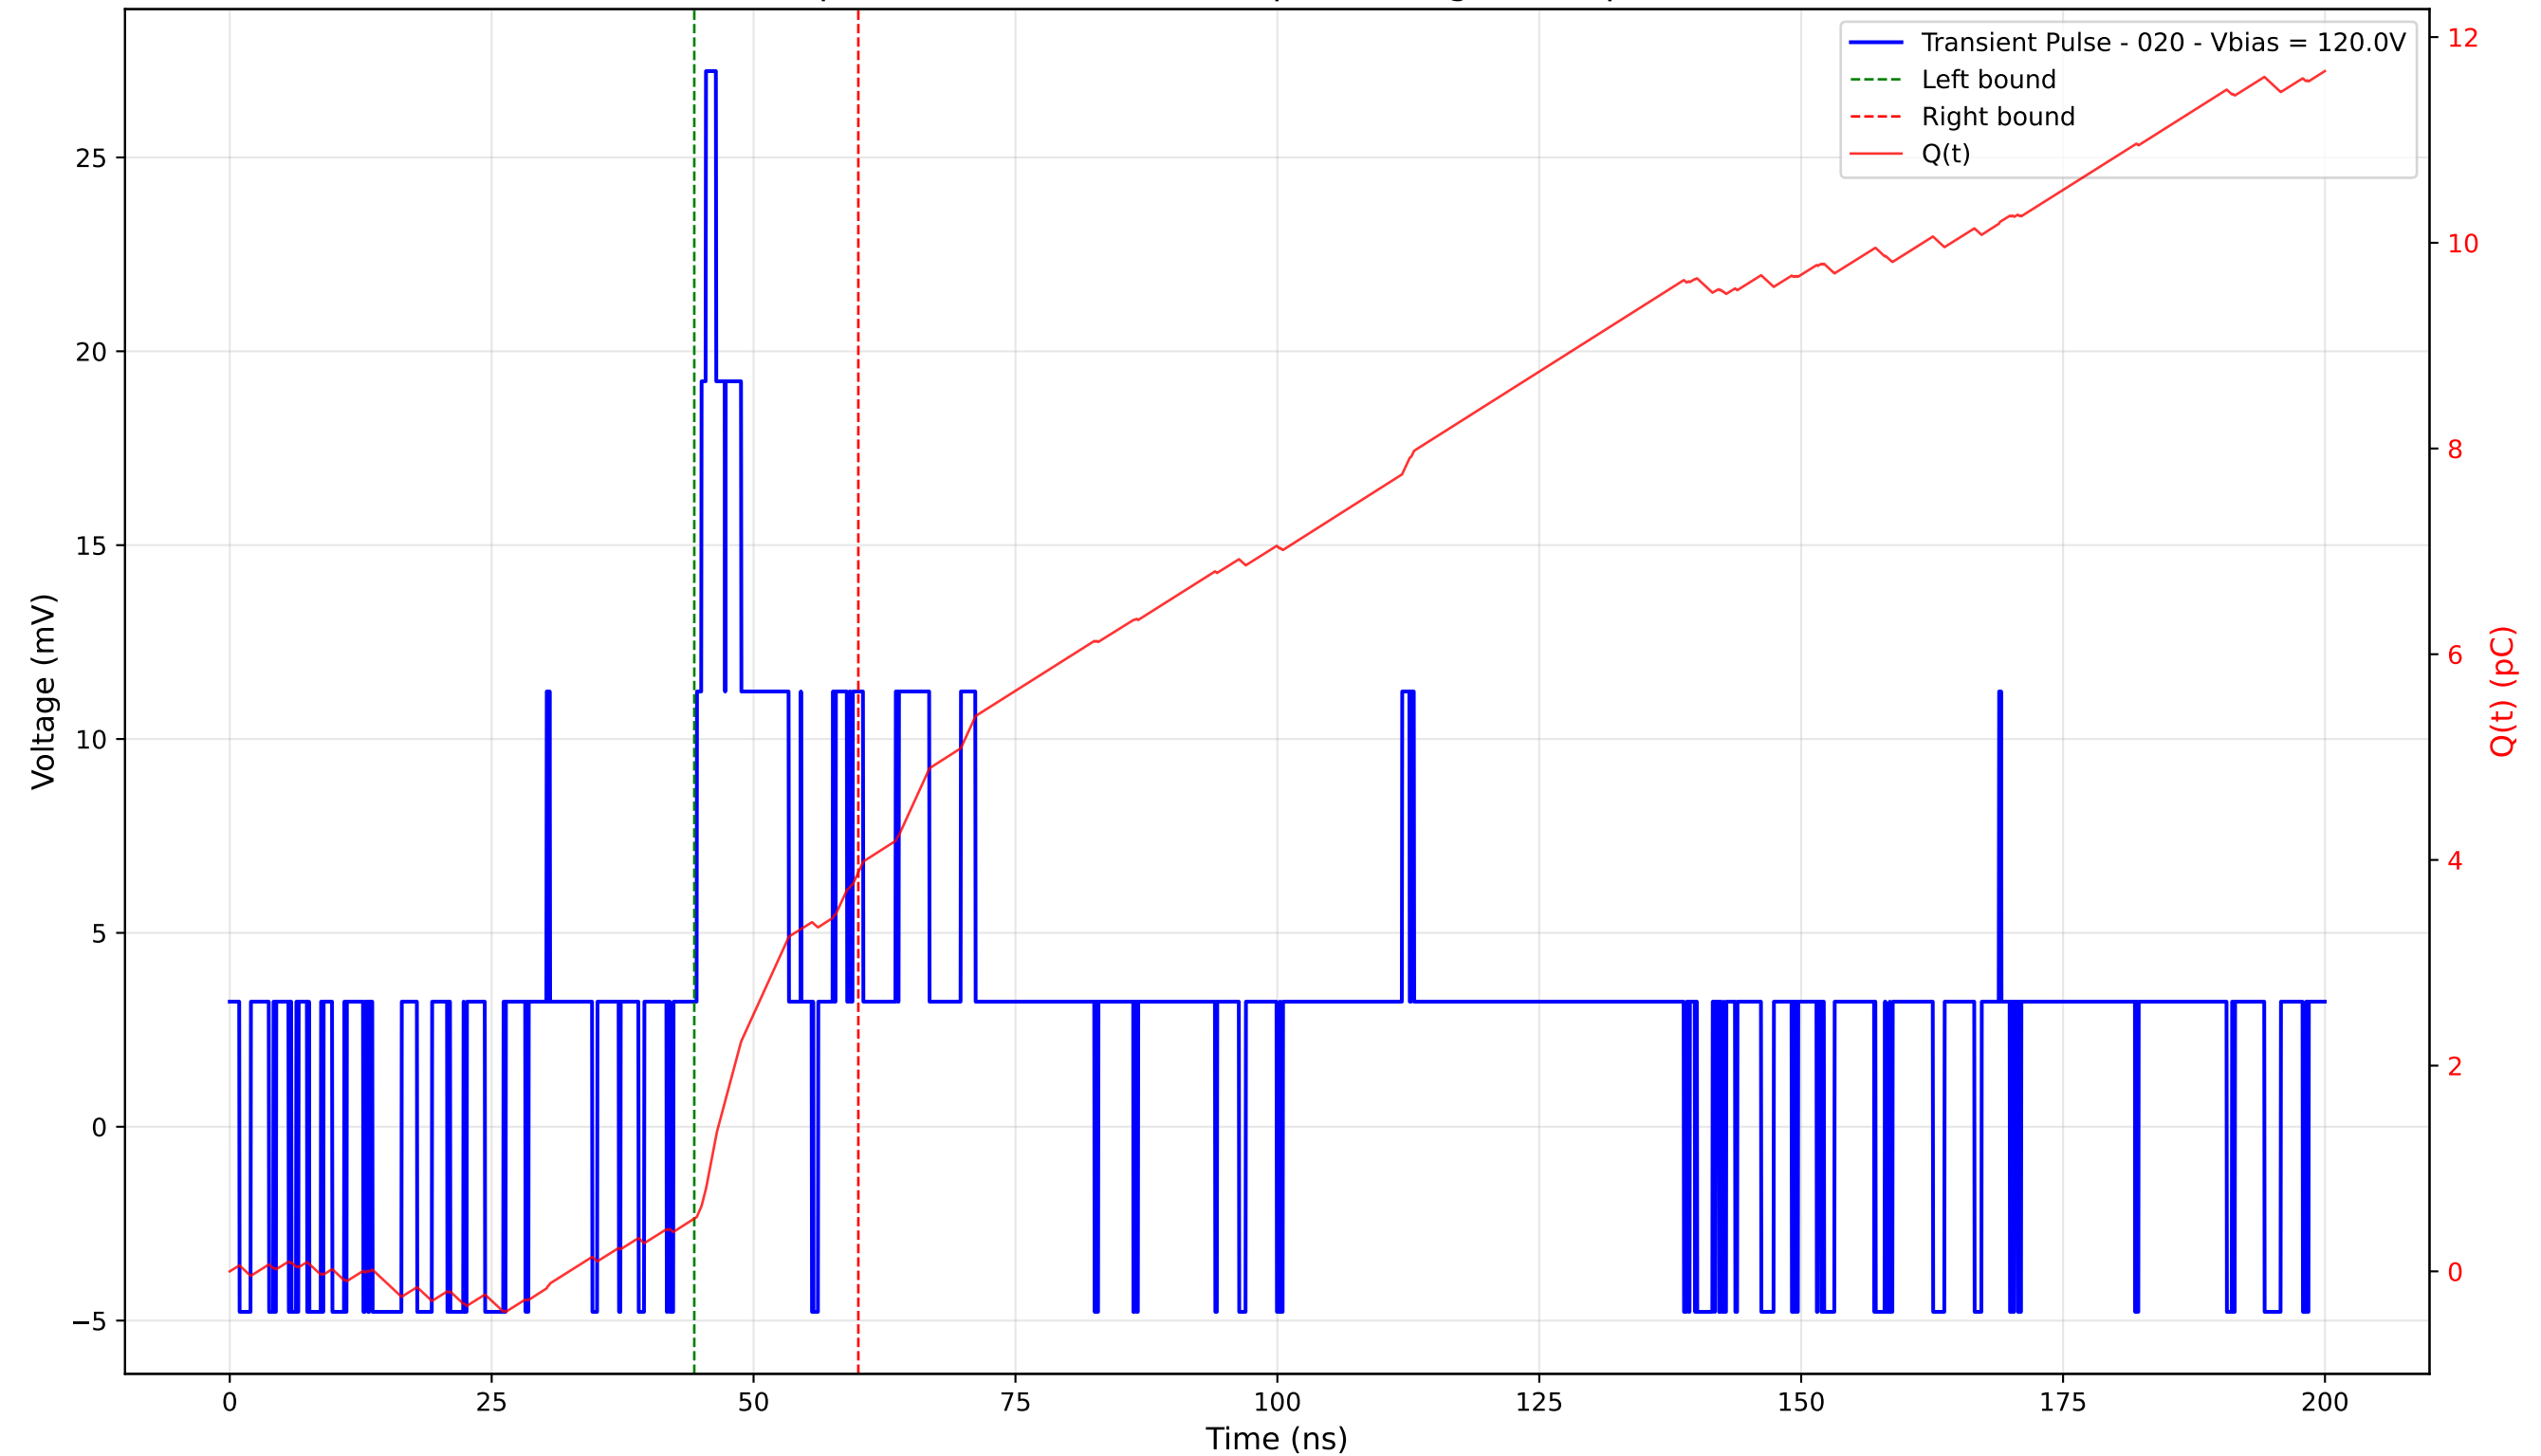


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 2.04 pC - Rise Time: 0.00 ns (N/A)

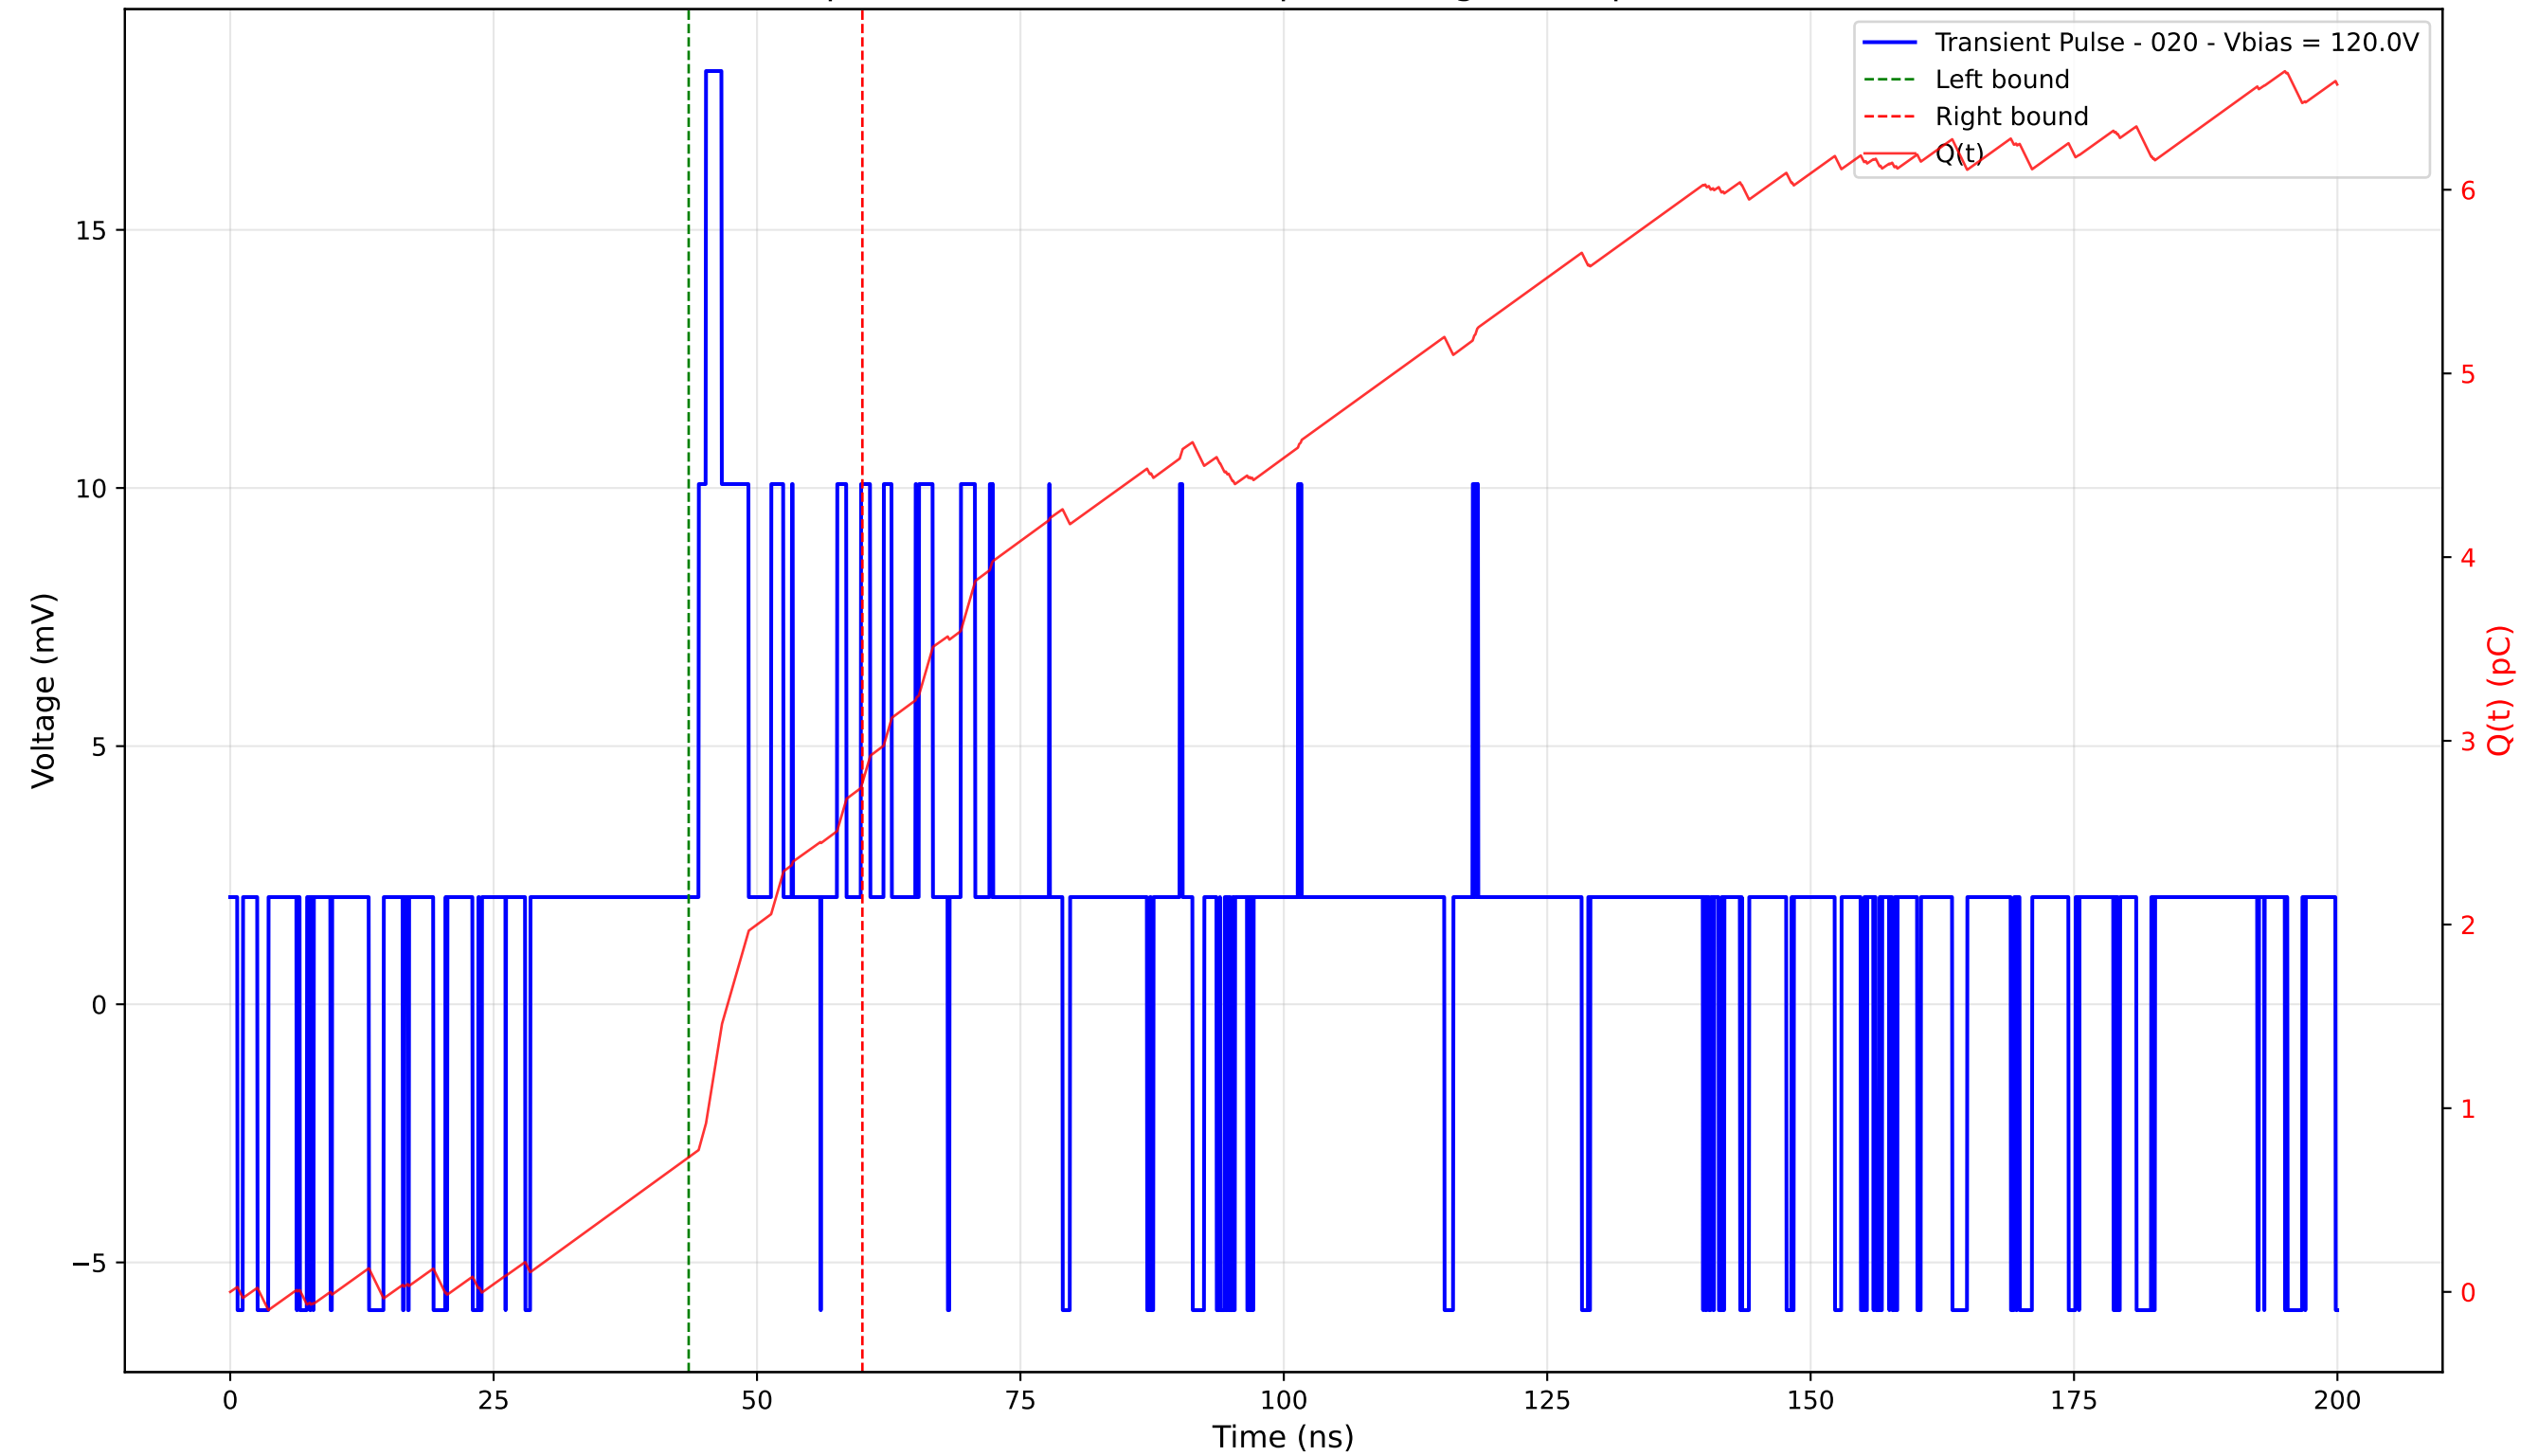


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 1.58 pC - Rise Time: 0.52 ns

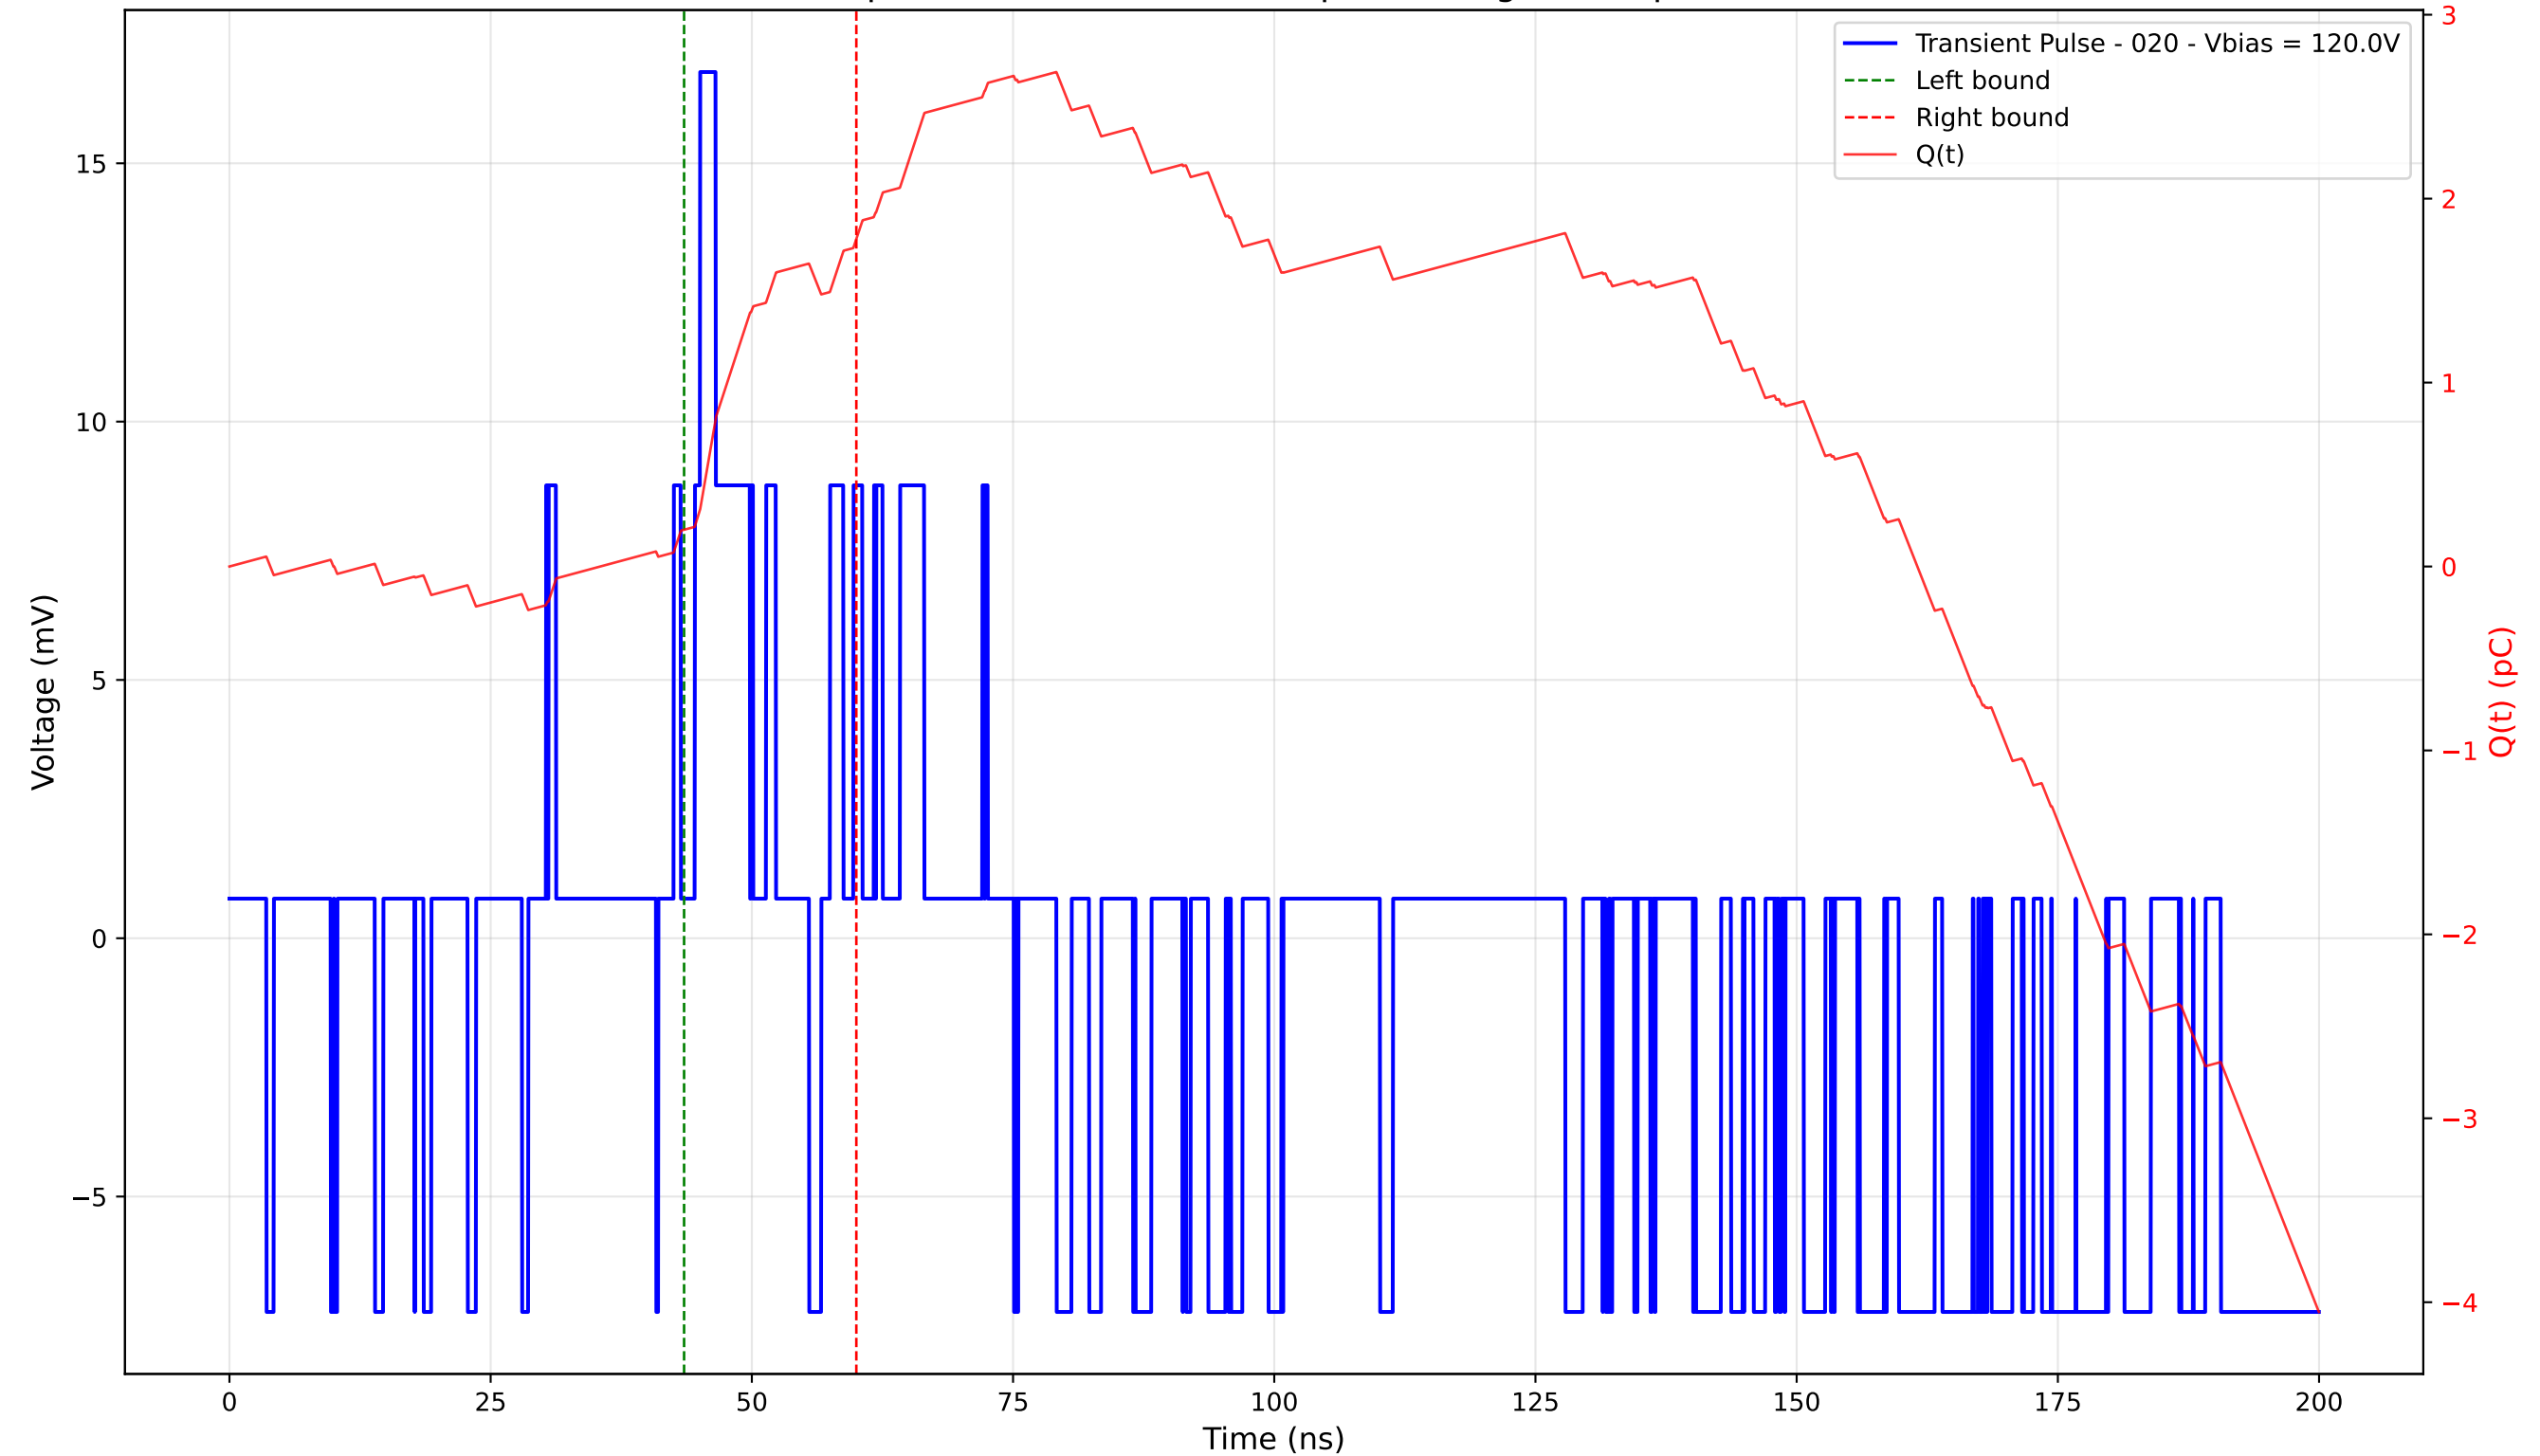


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.23 pC - Rise Time: 0.76 ns

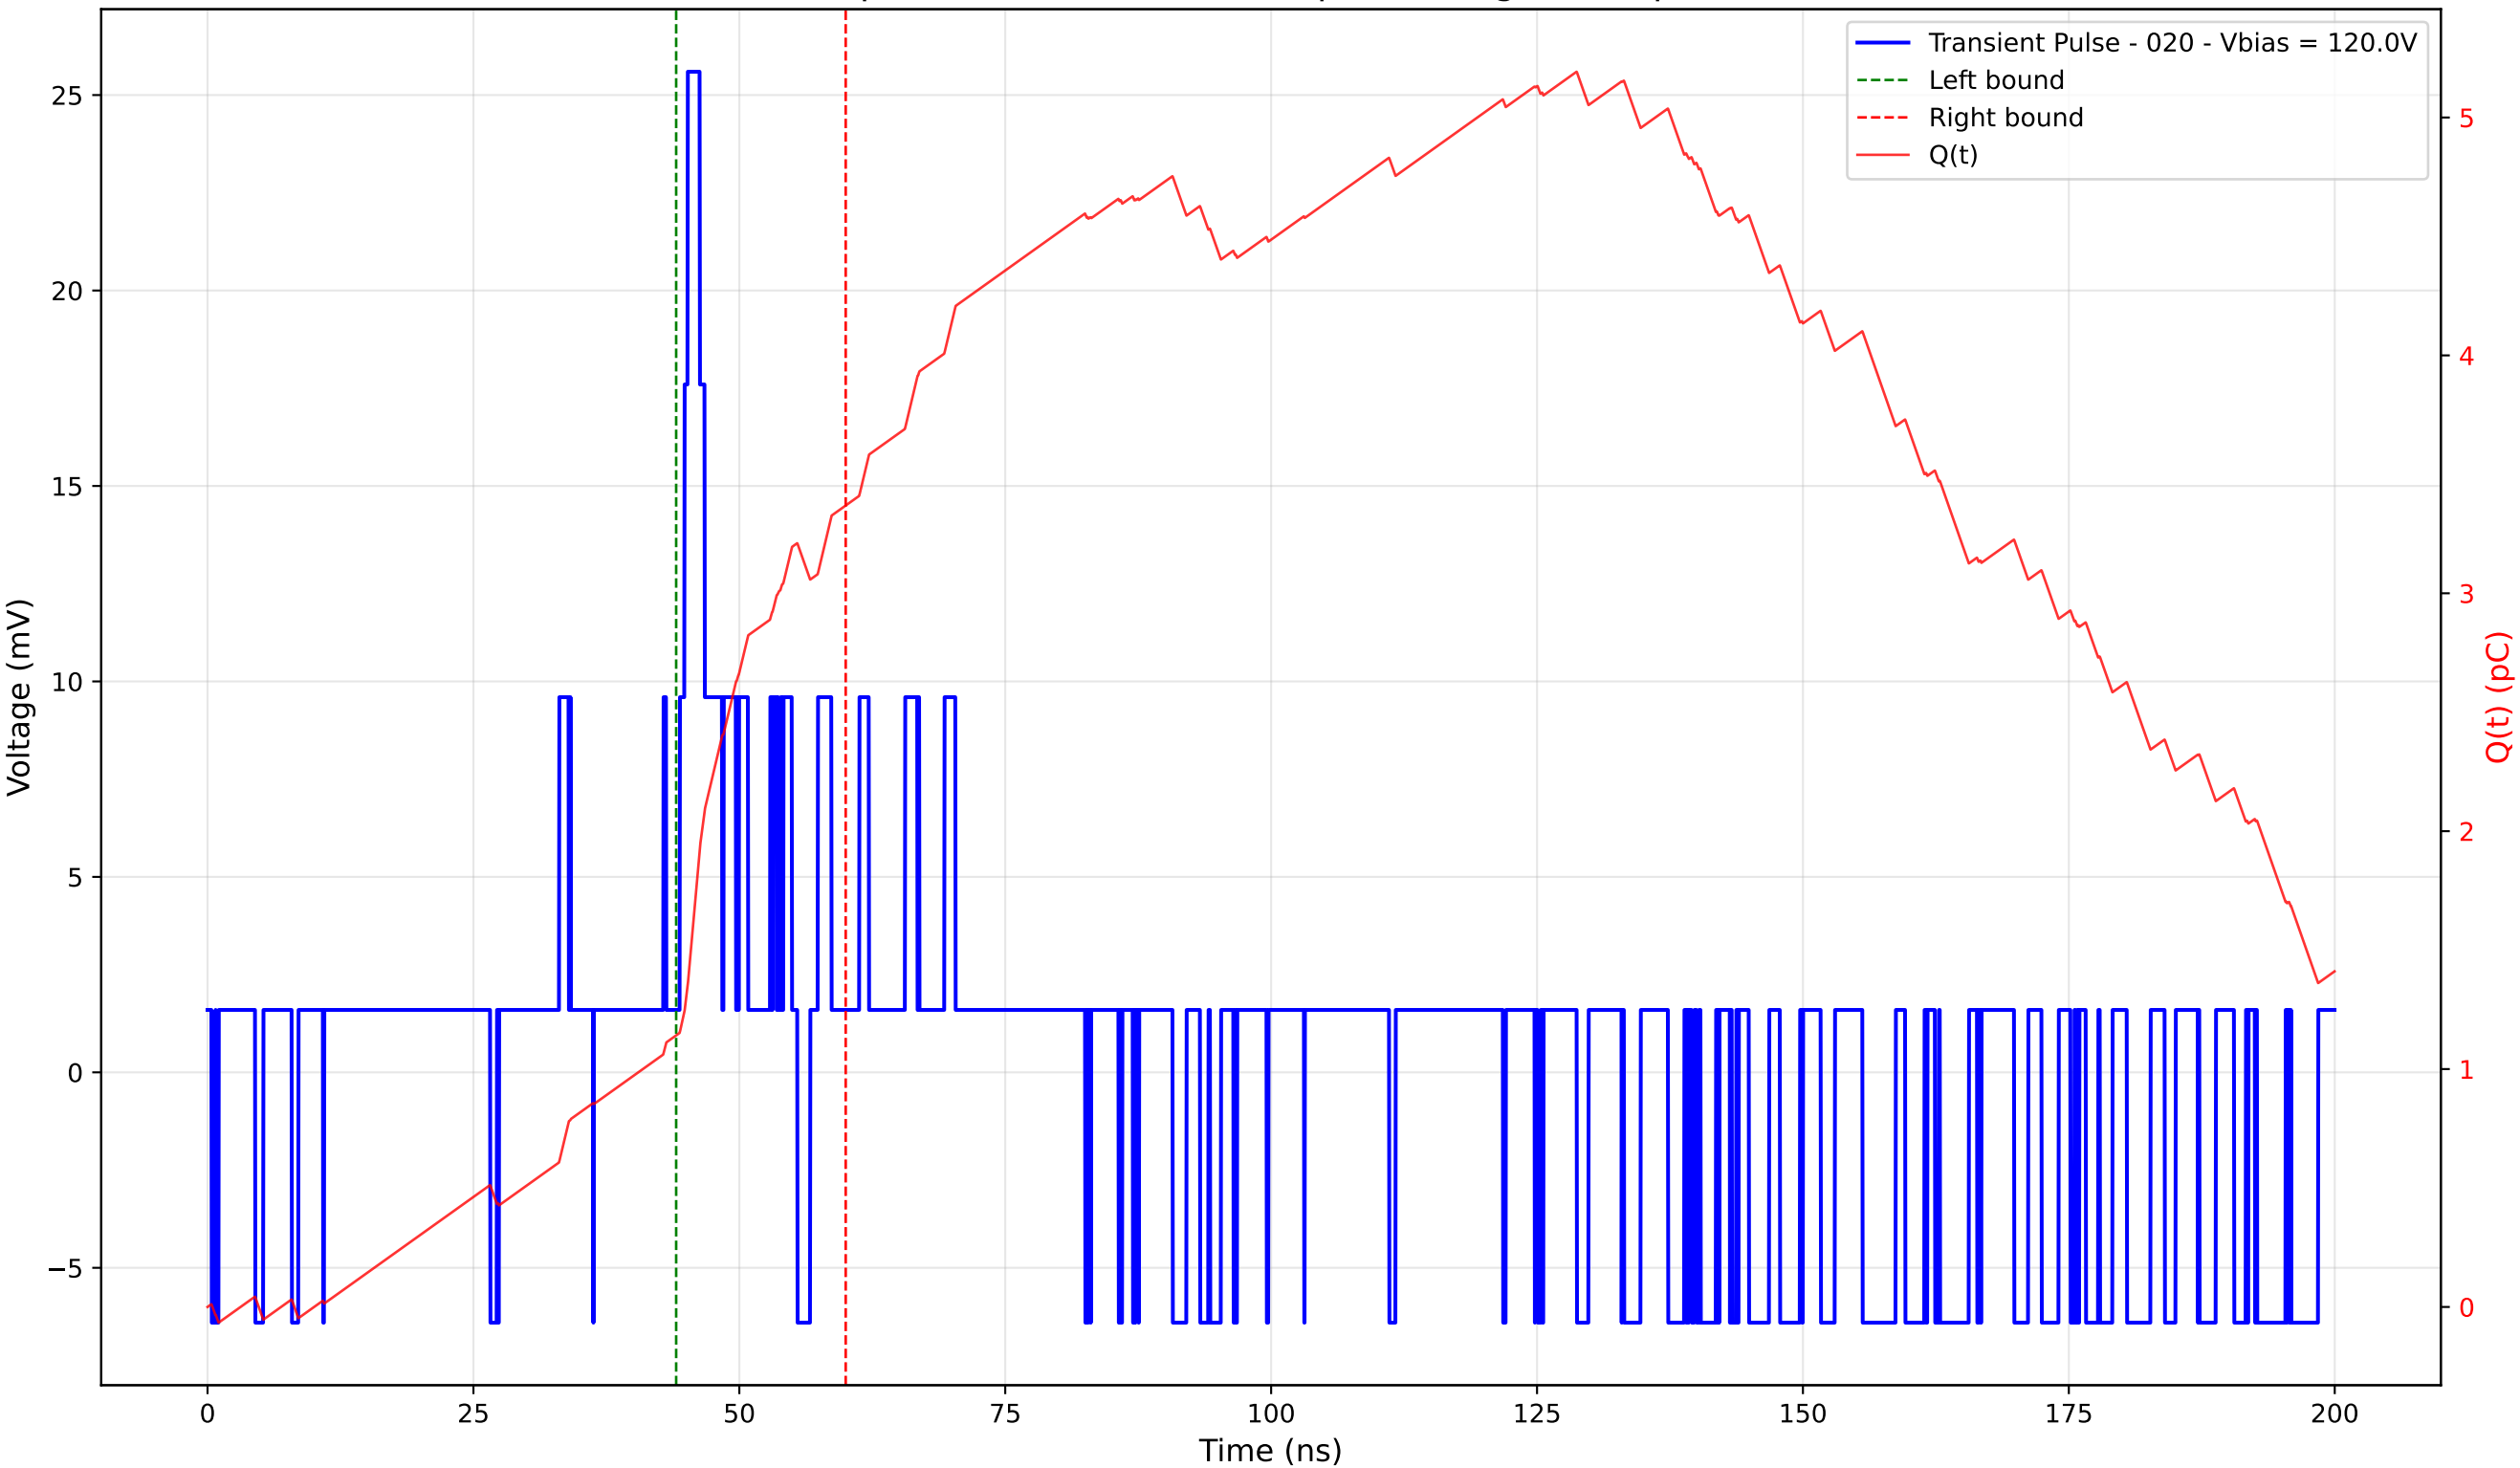


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 2.51 pC - Rise Time: 1.02 ns

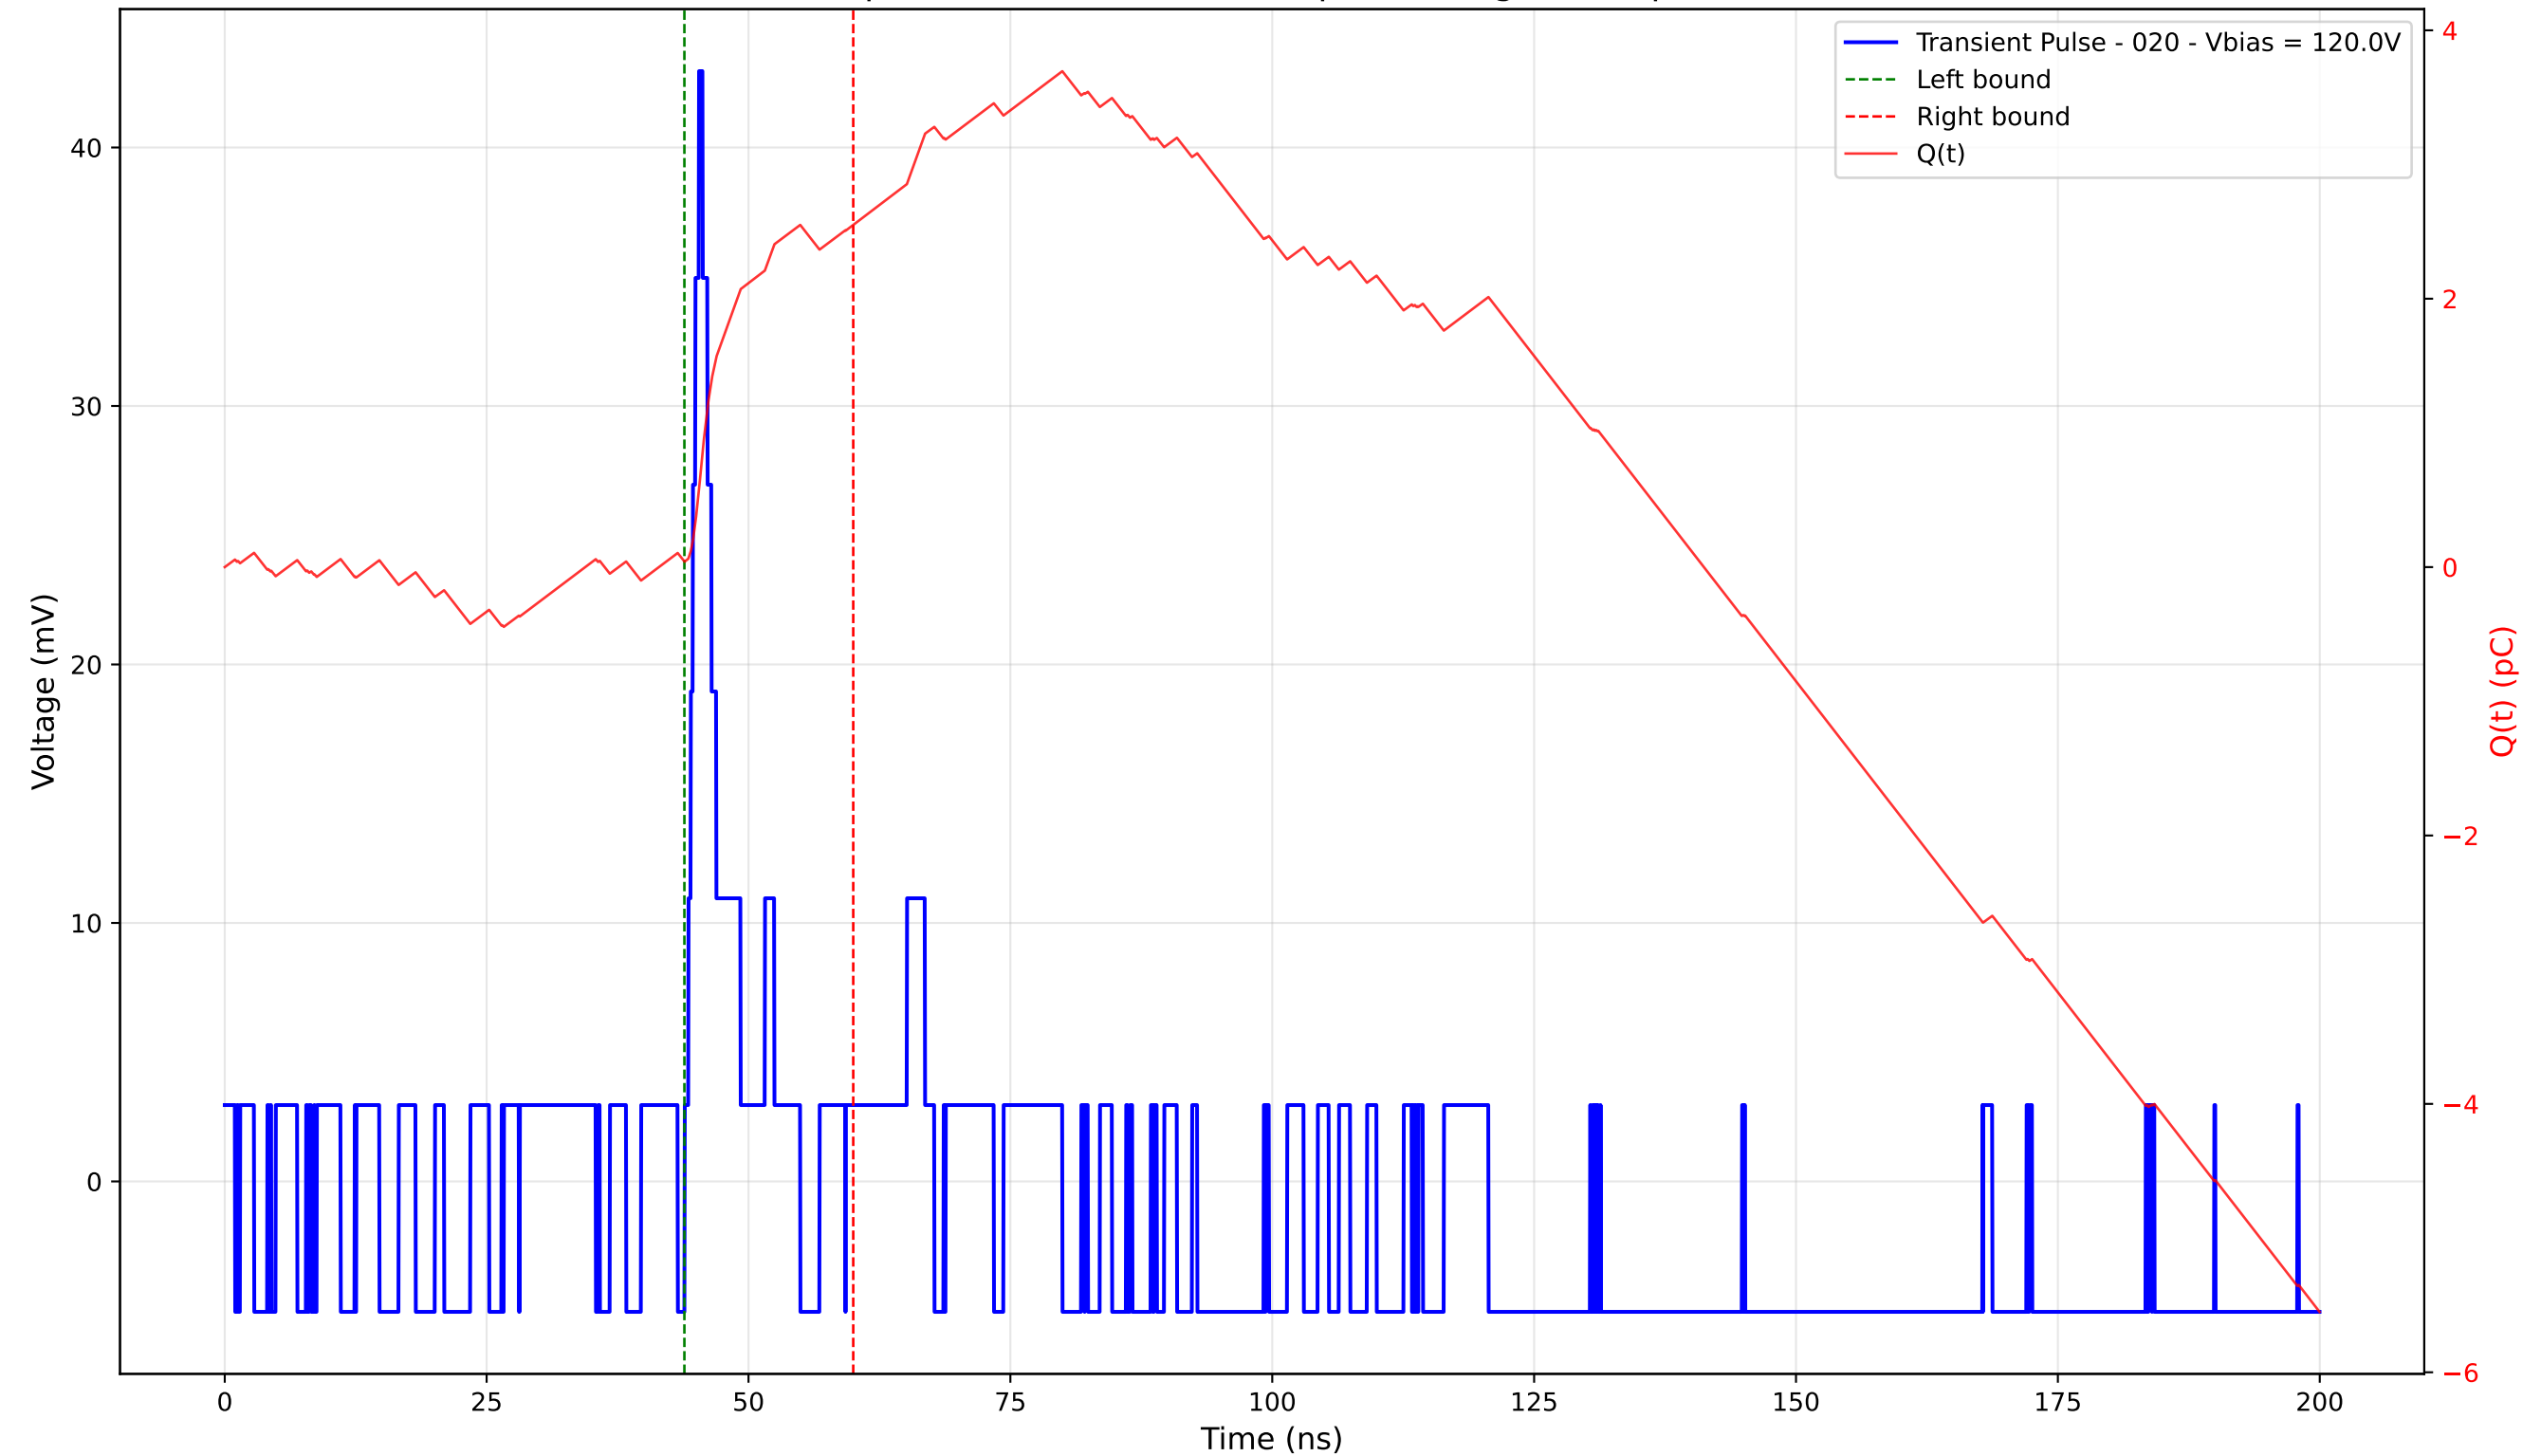


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 4.37 pC - Rise Time: 1.00 ns

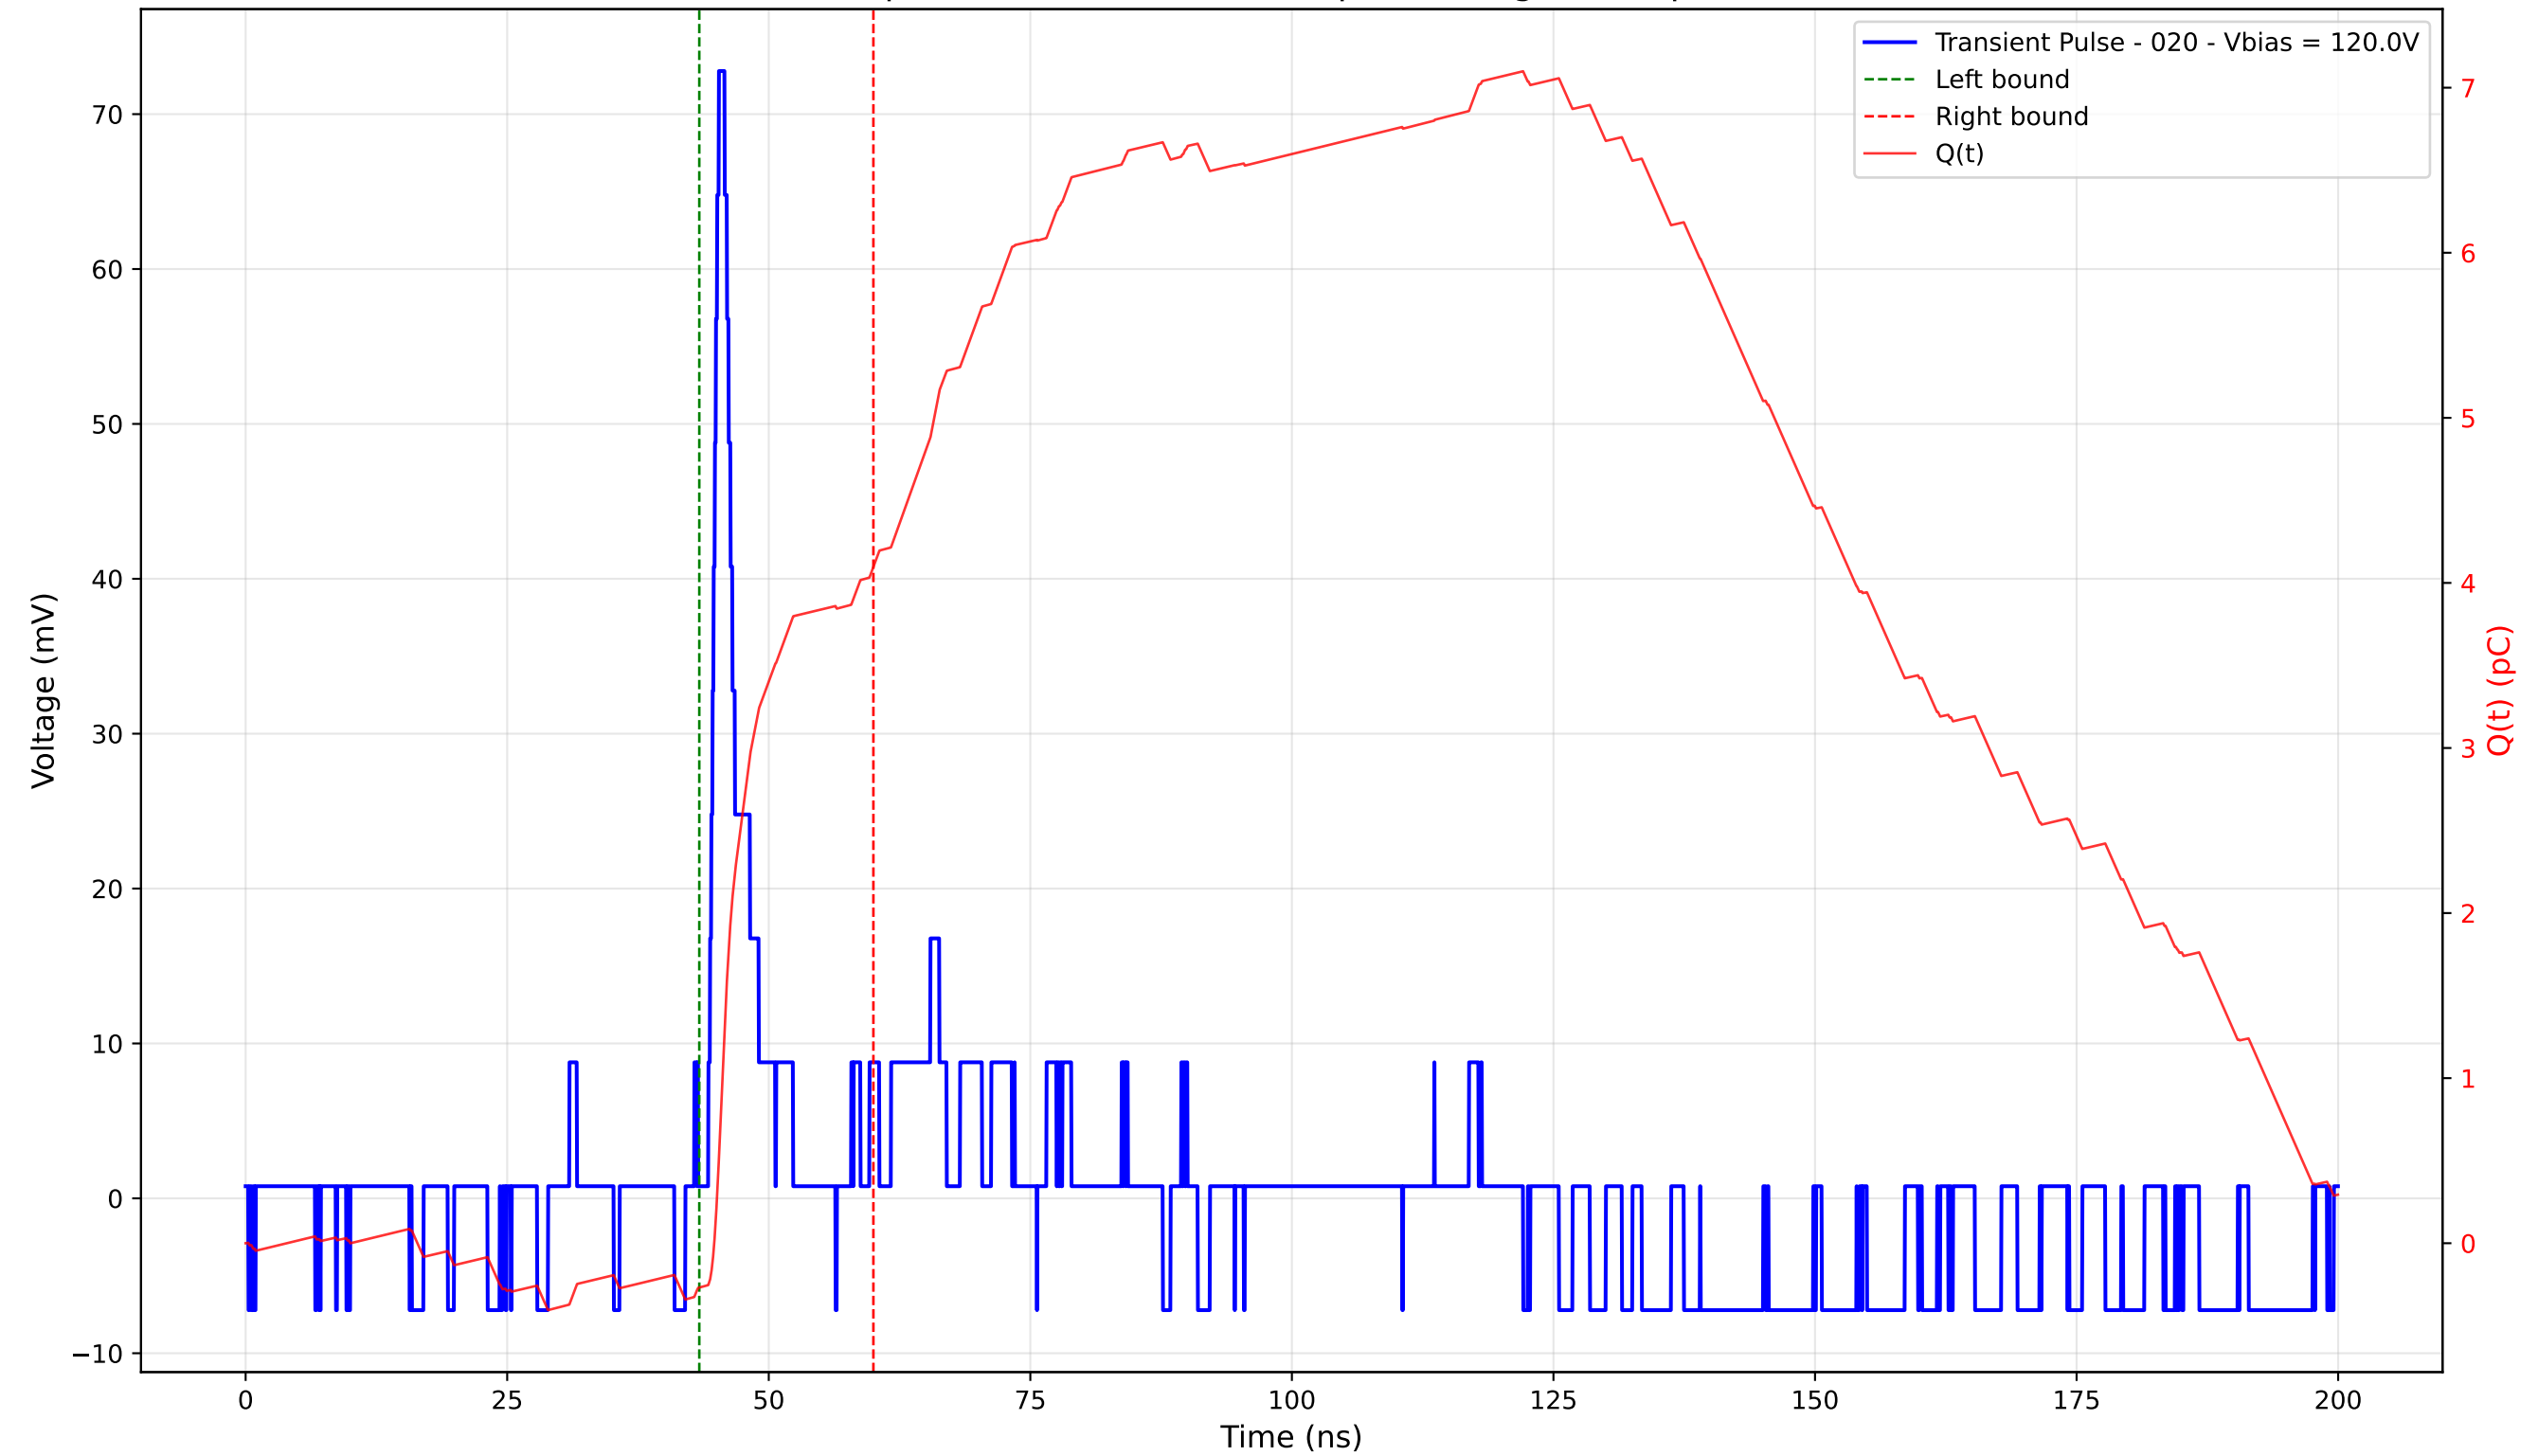


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 7.48 pC - Rise Time: 0.88 ns

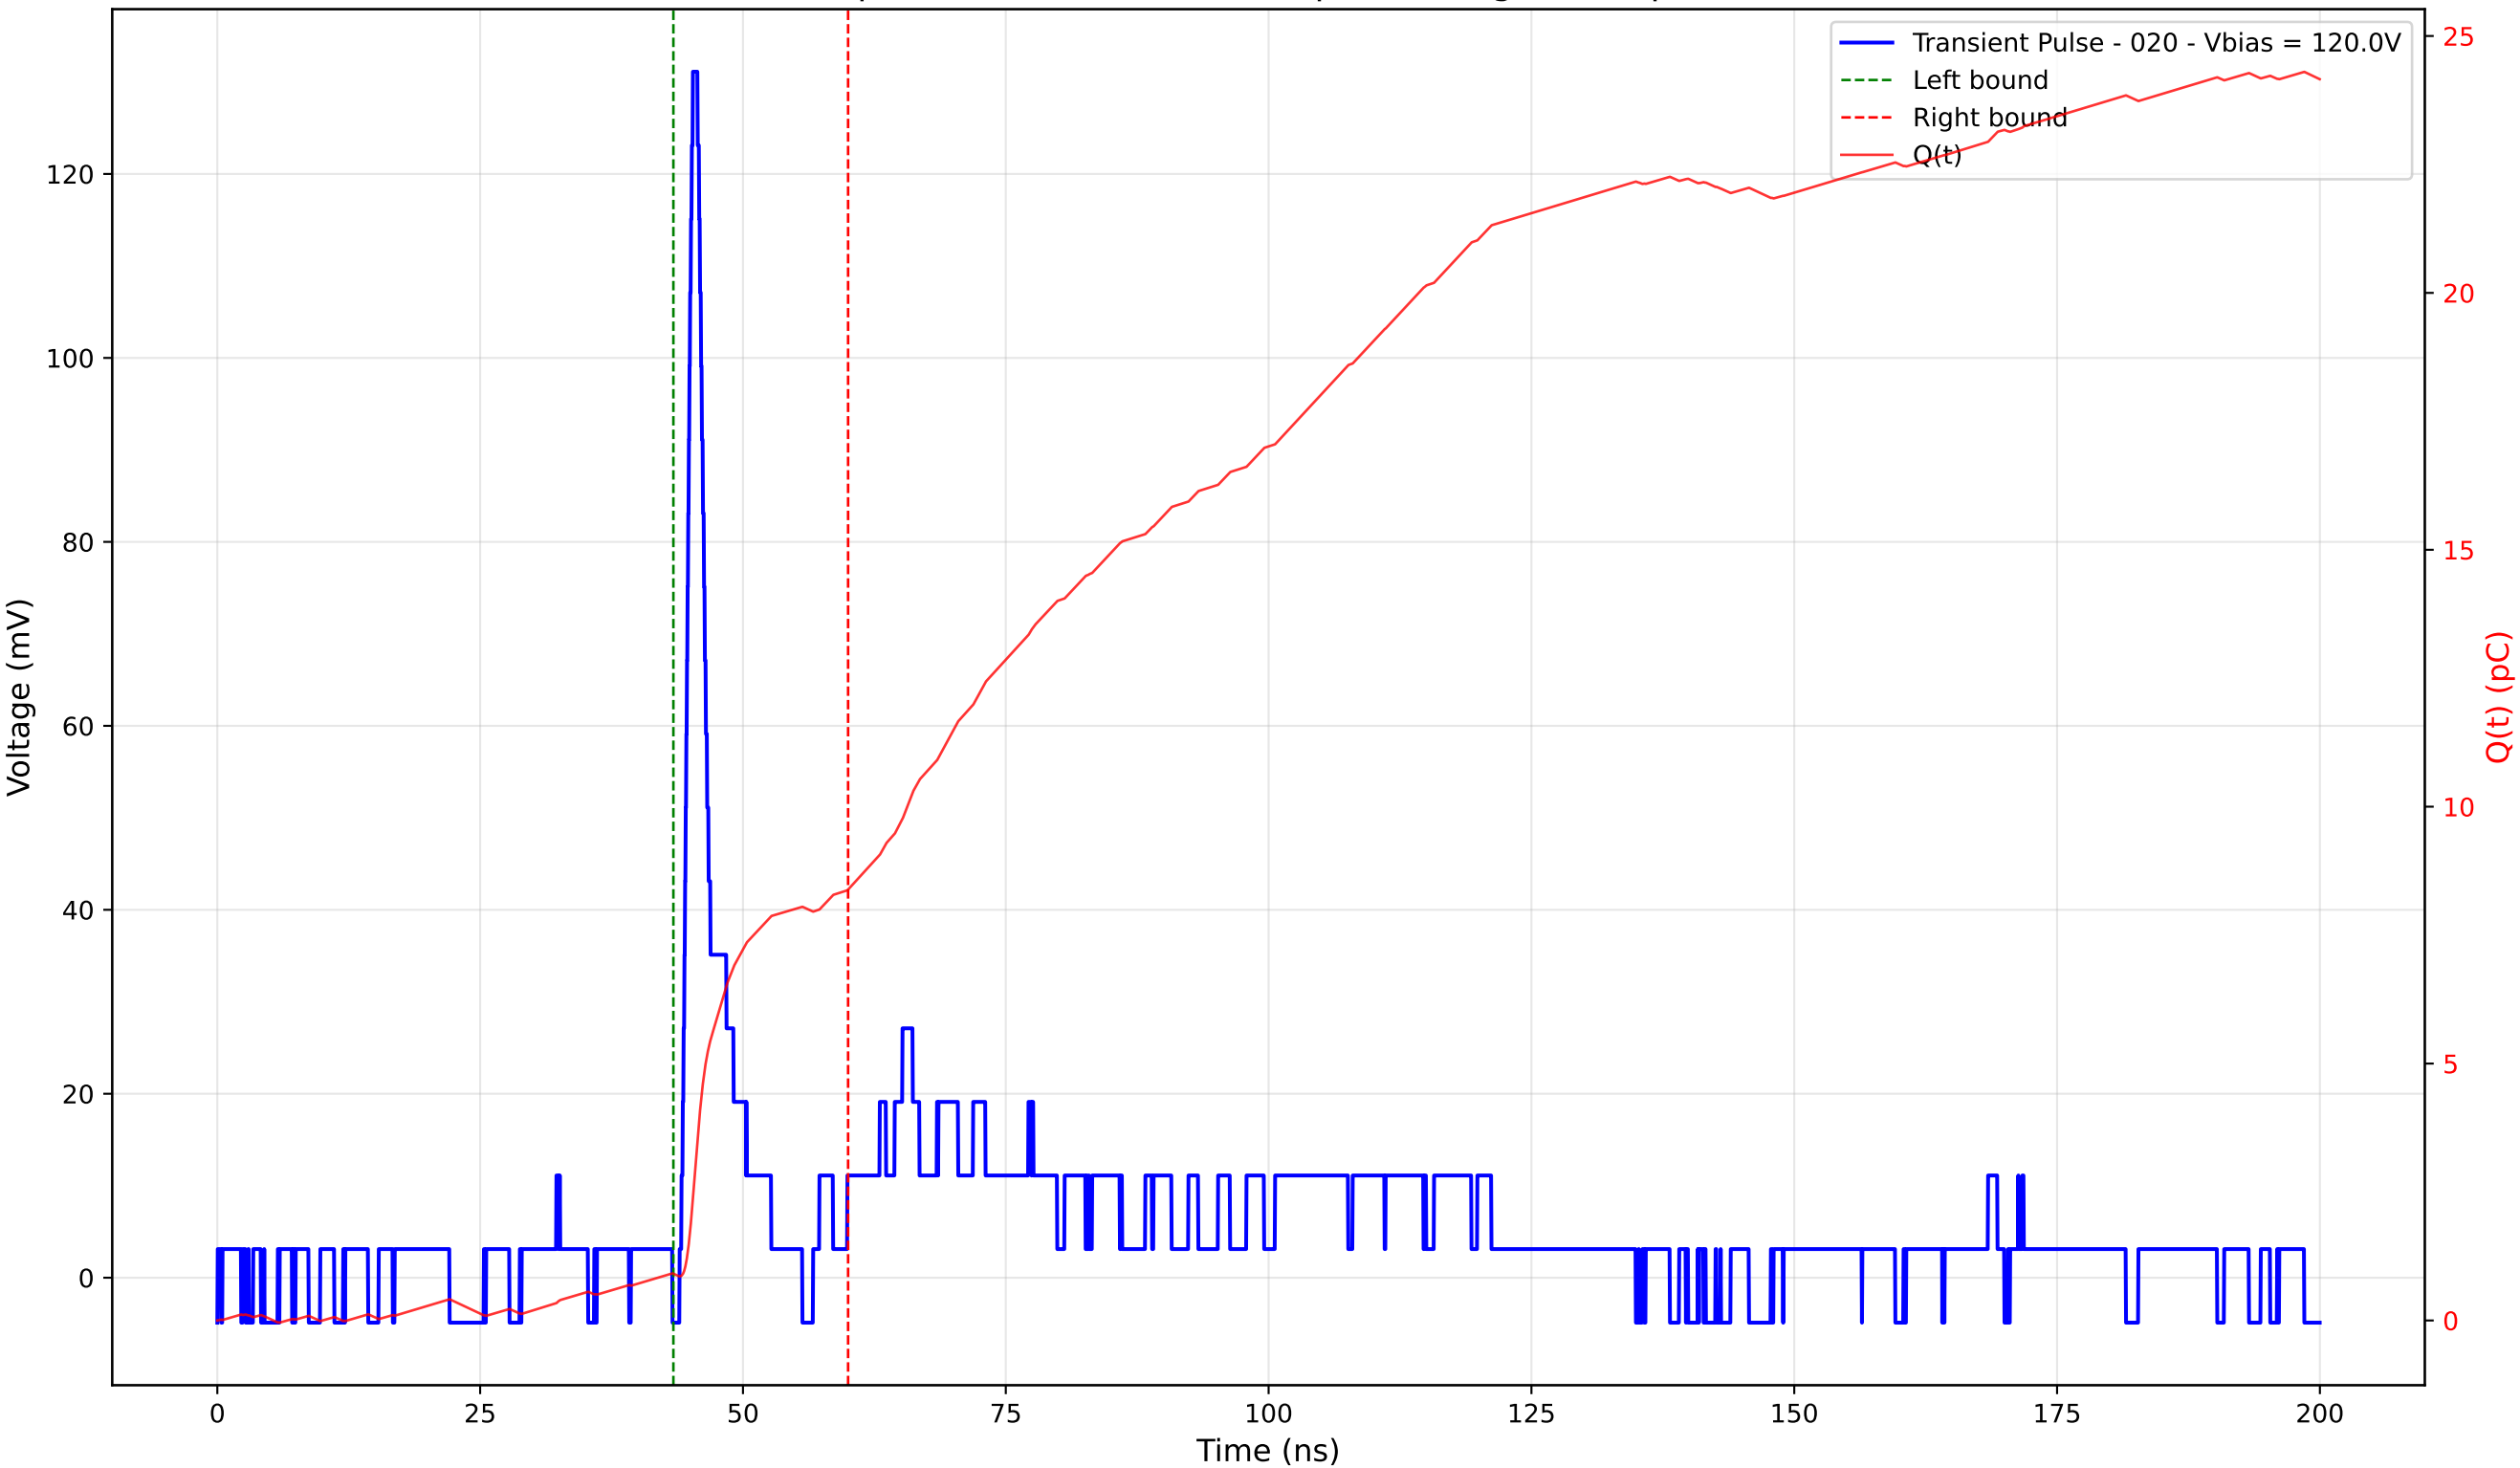


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 10.00 pC - Rise Time: 0.94 ns

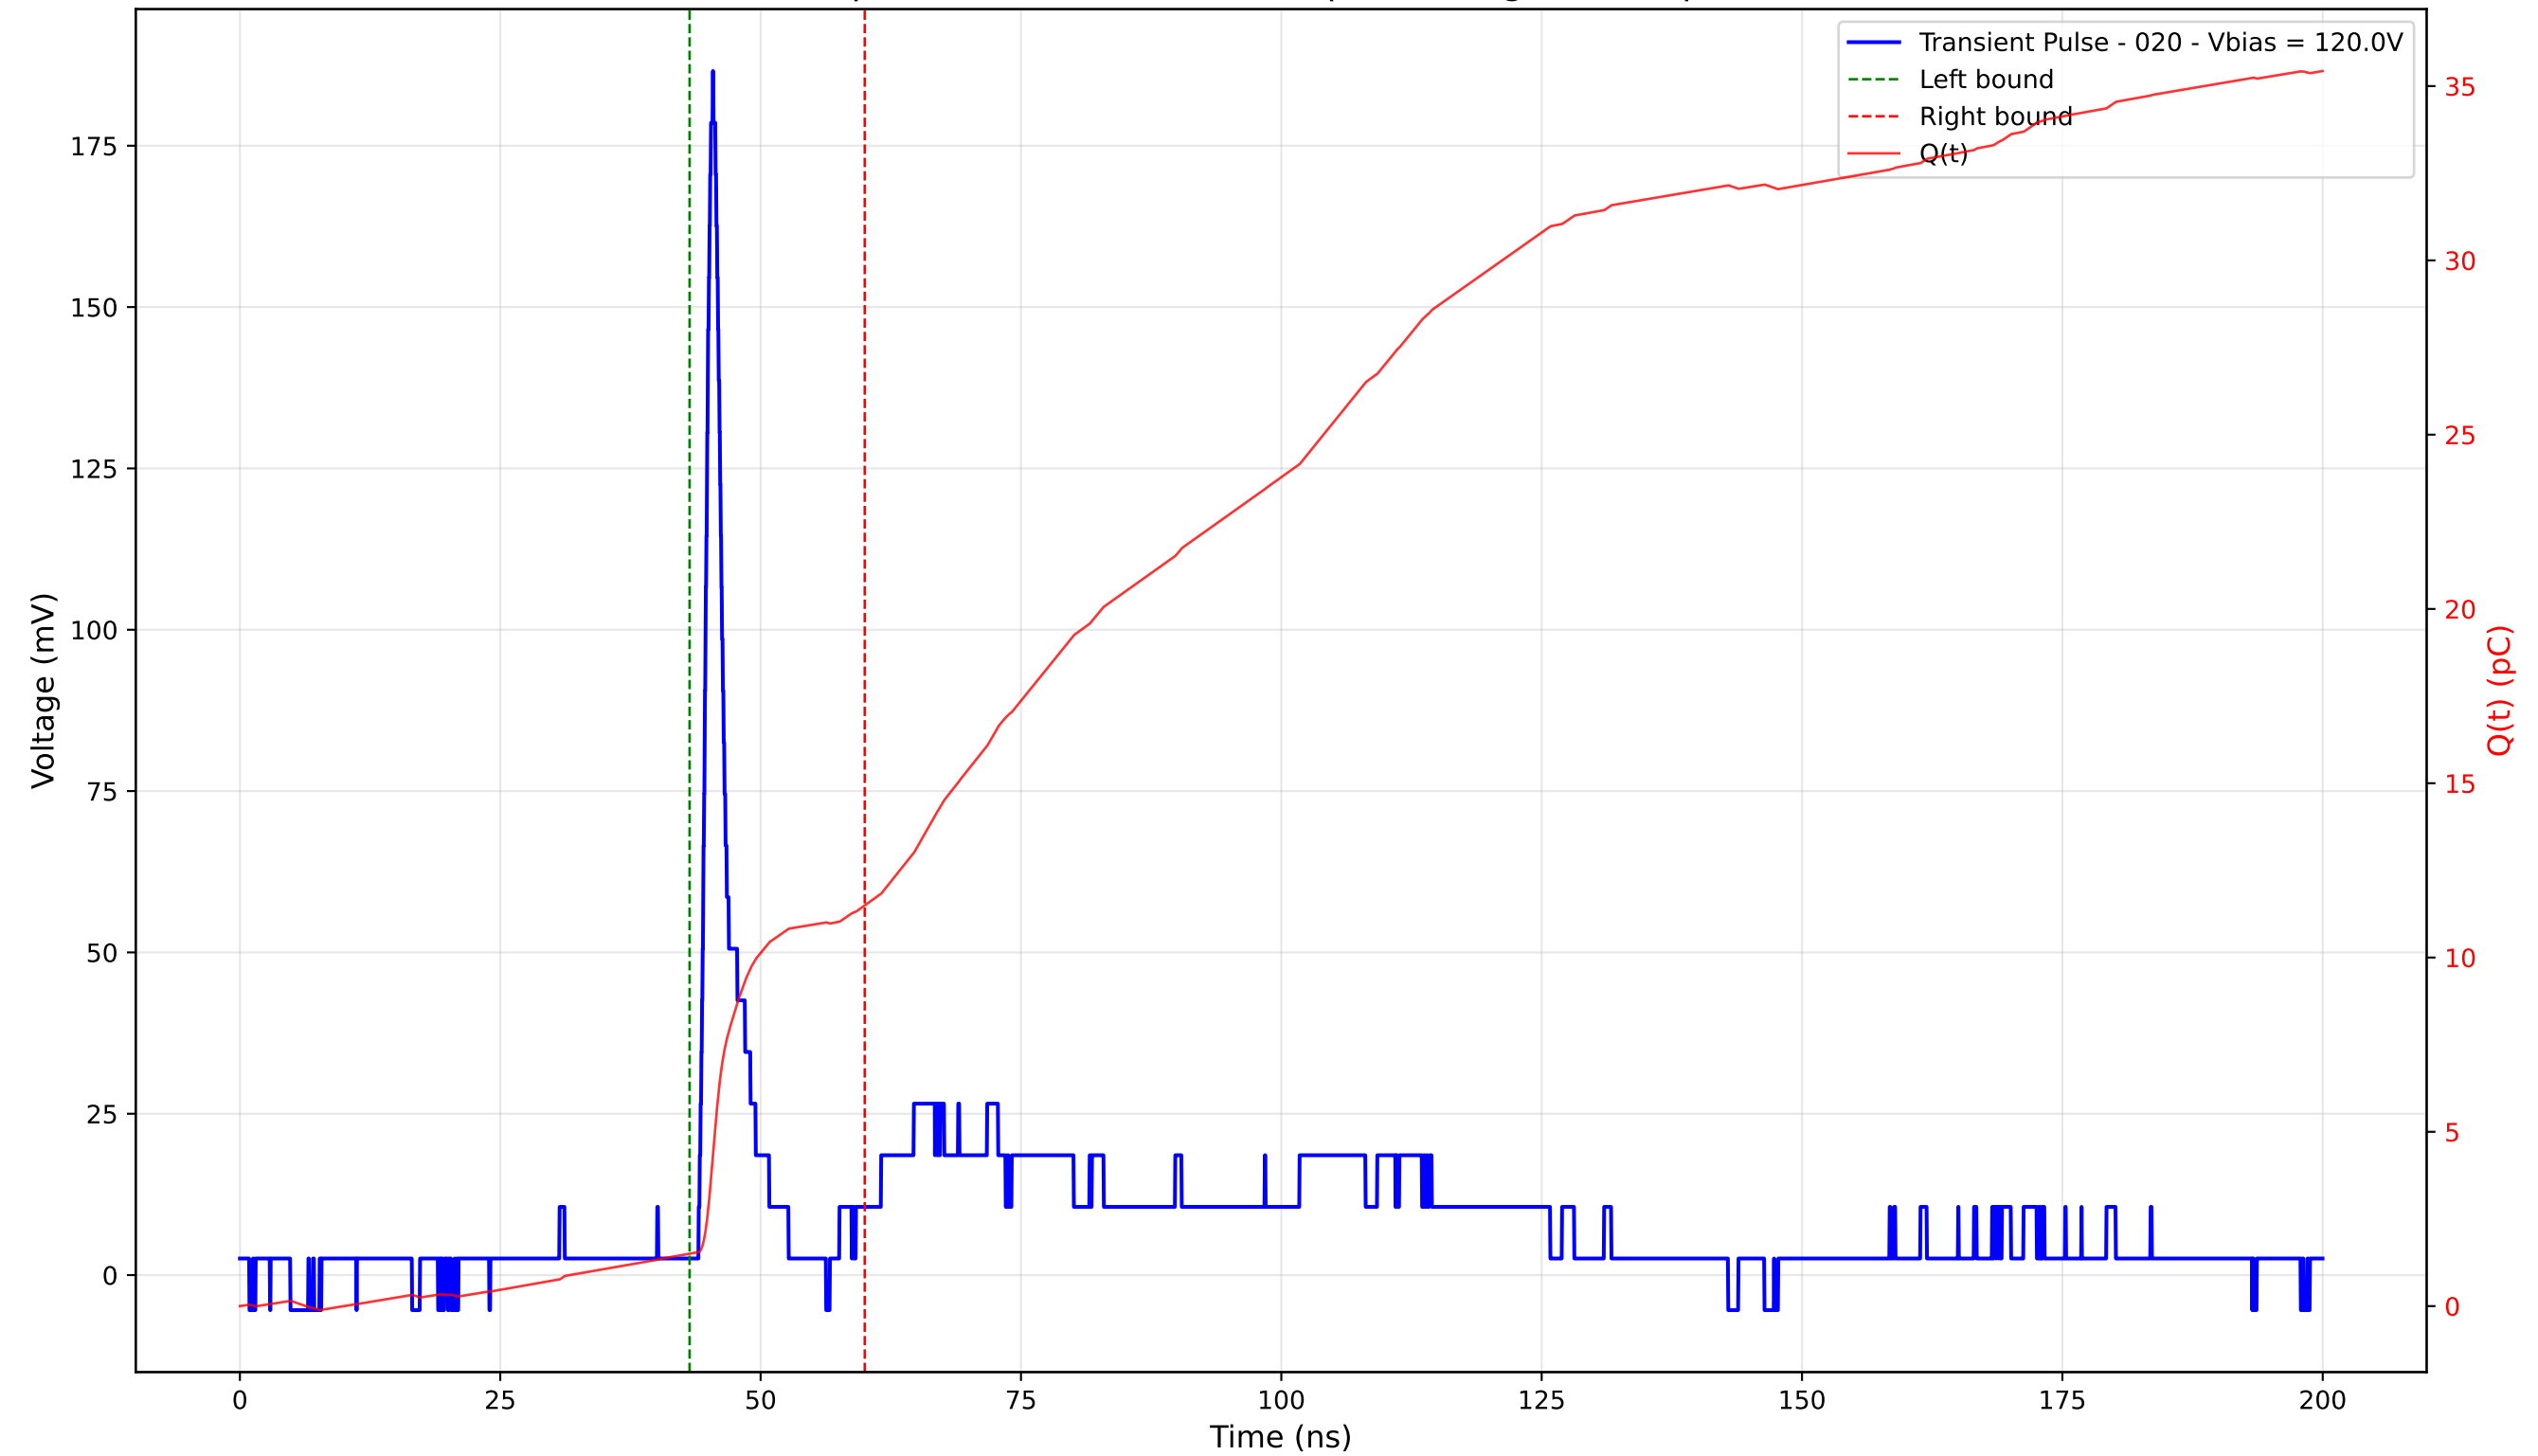


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 12.81 pC - Rise Time: 0.88 ns

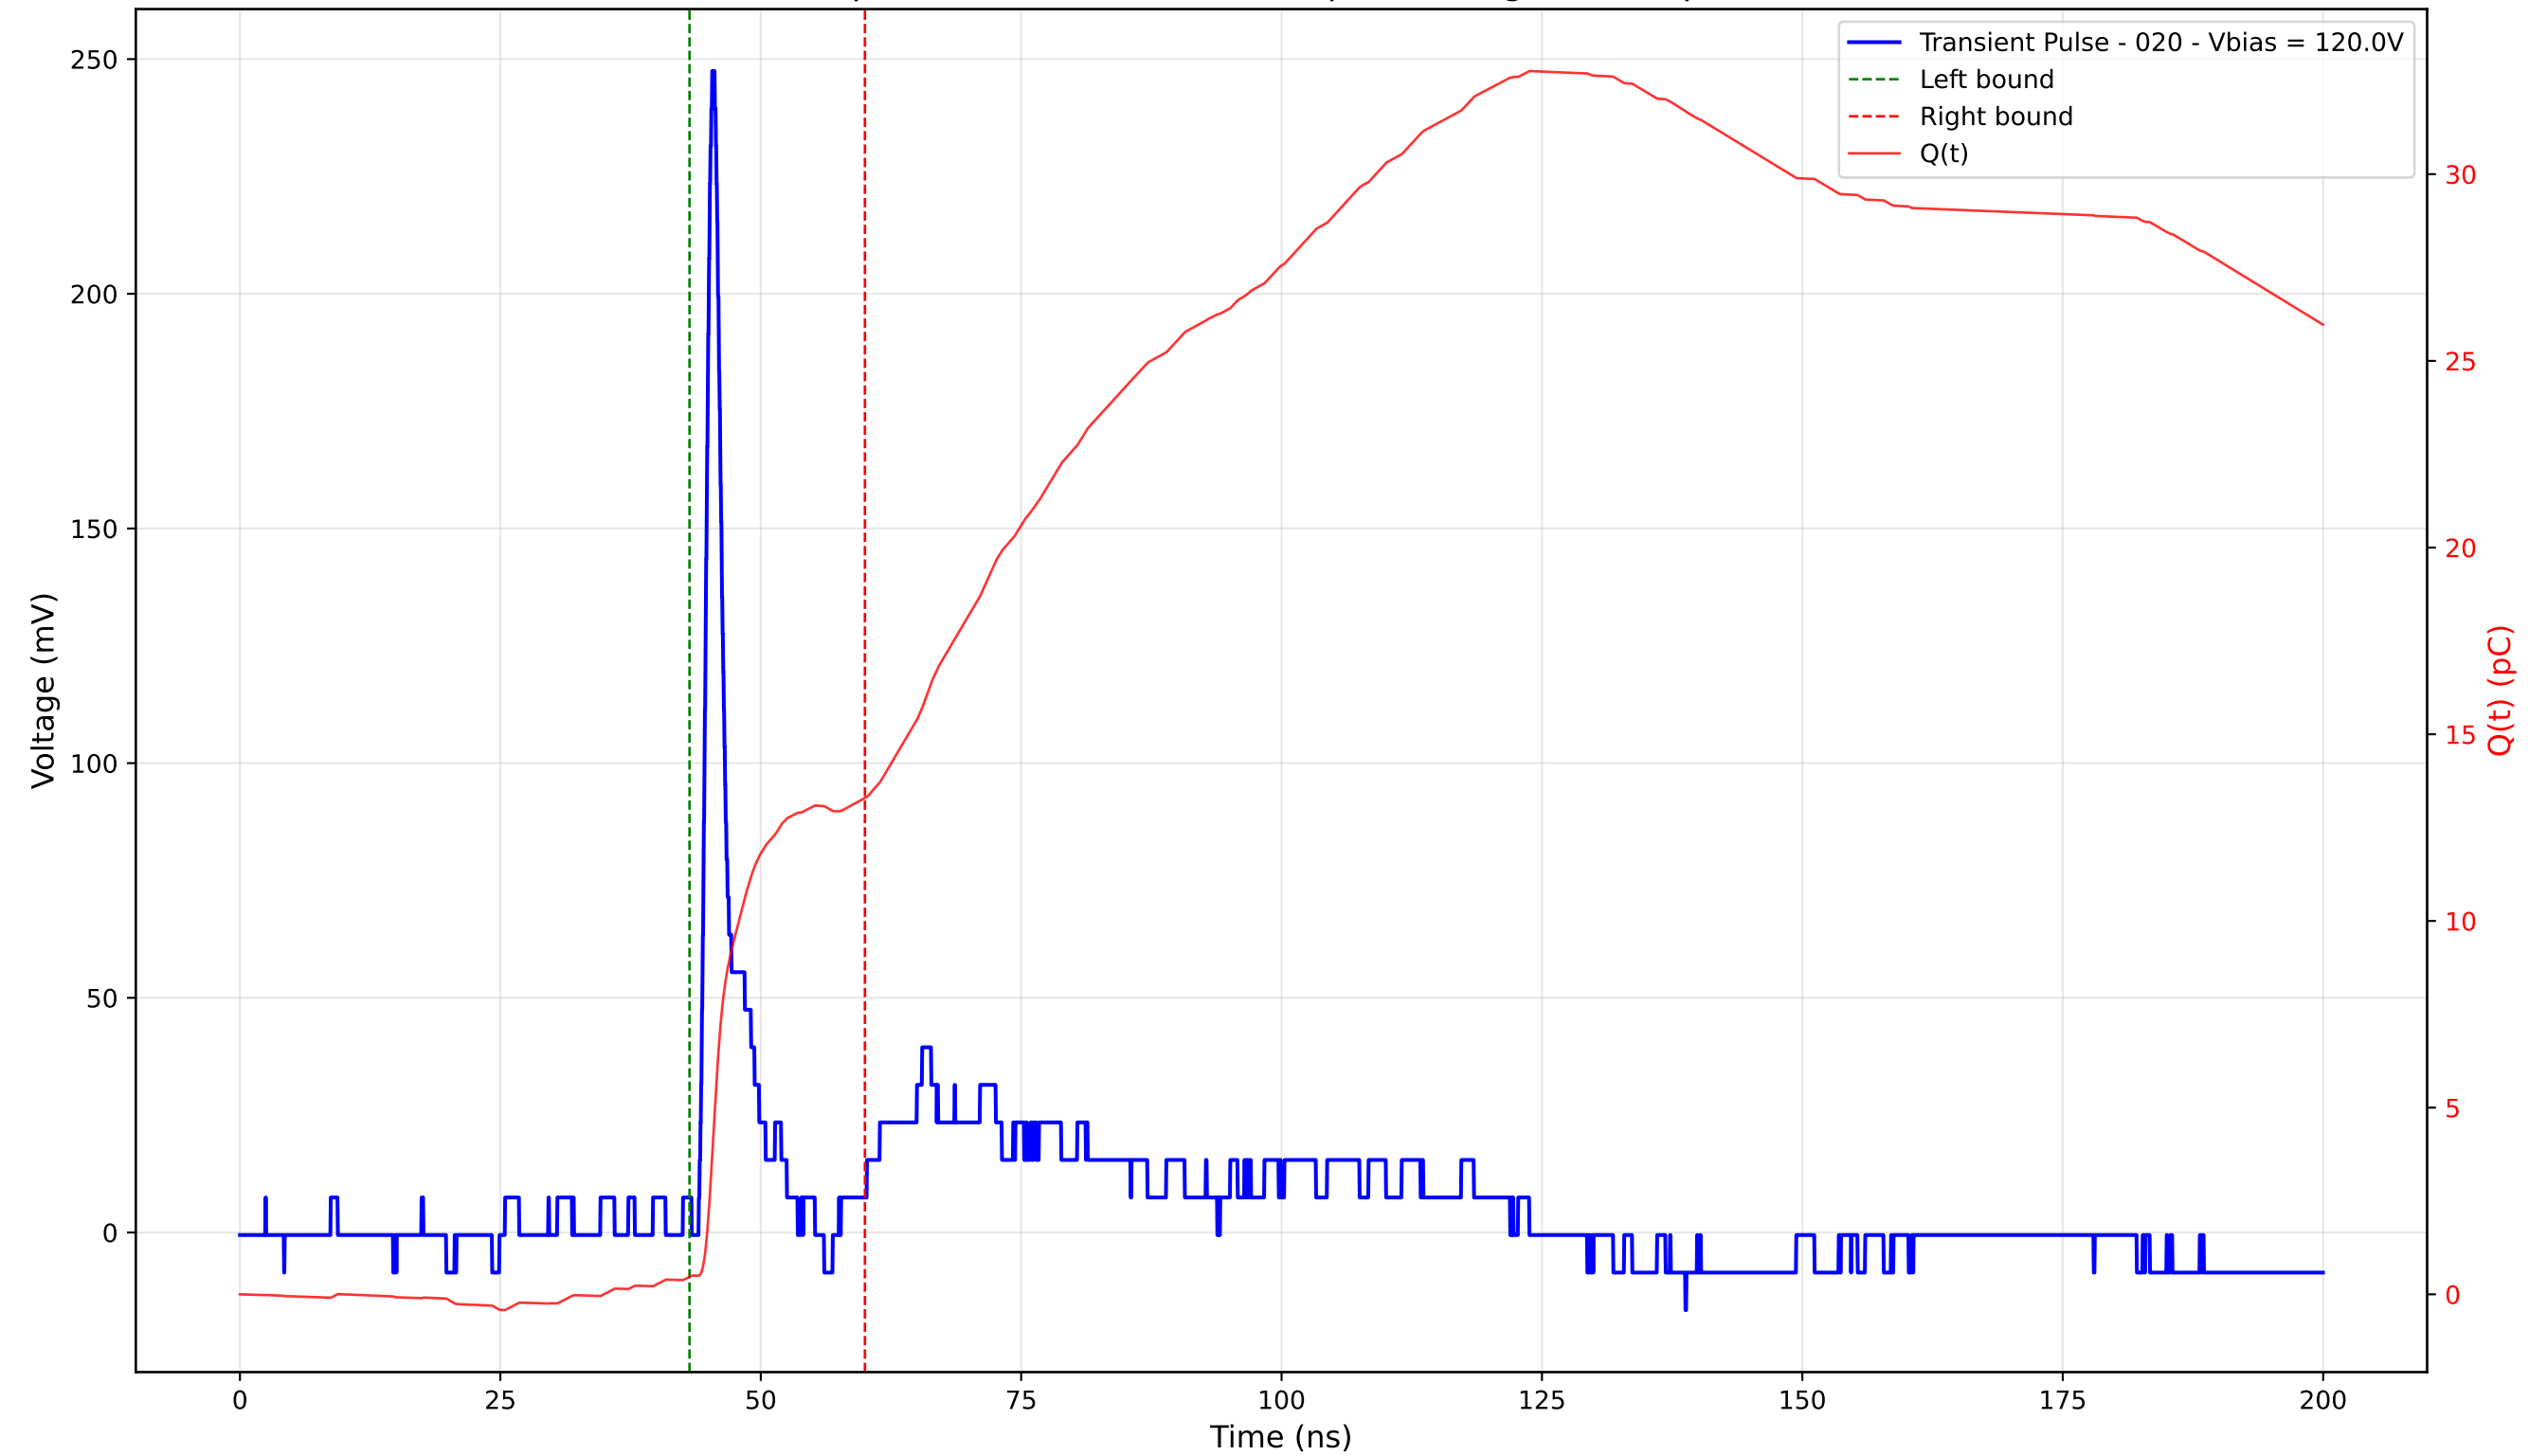


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 15.09 pC - Rise Time: 0.89 ns

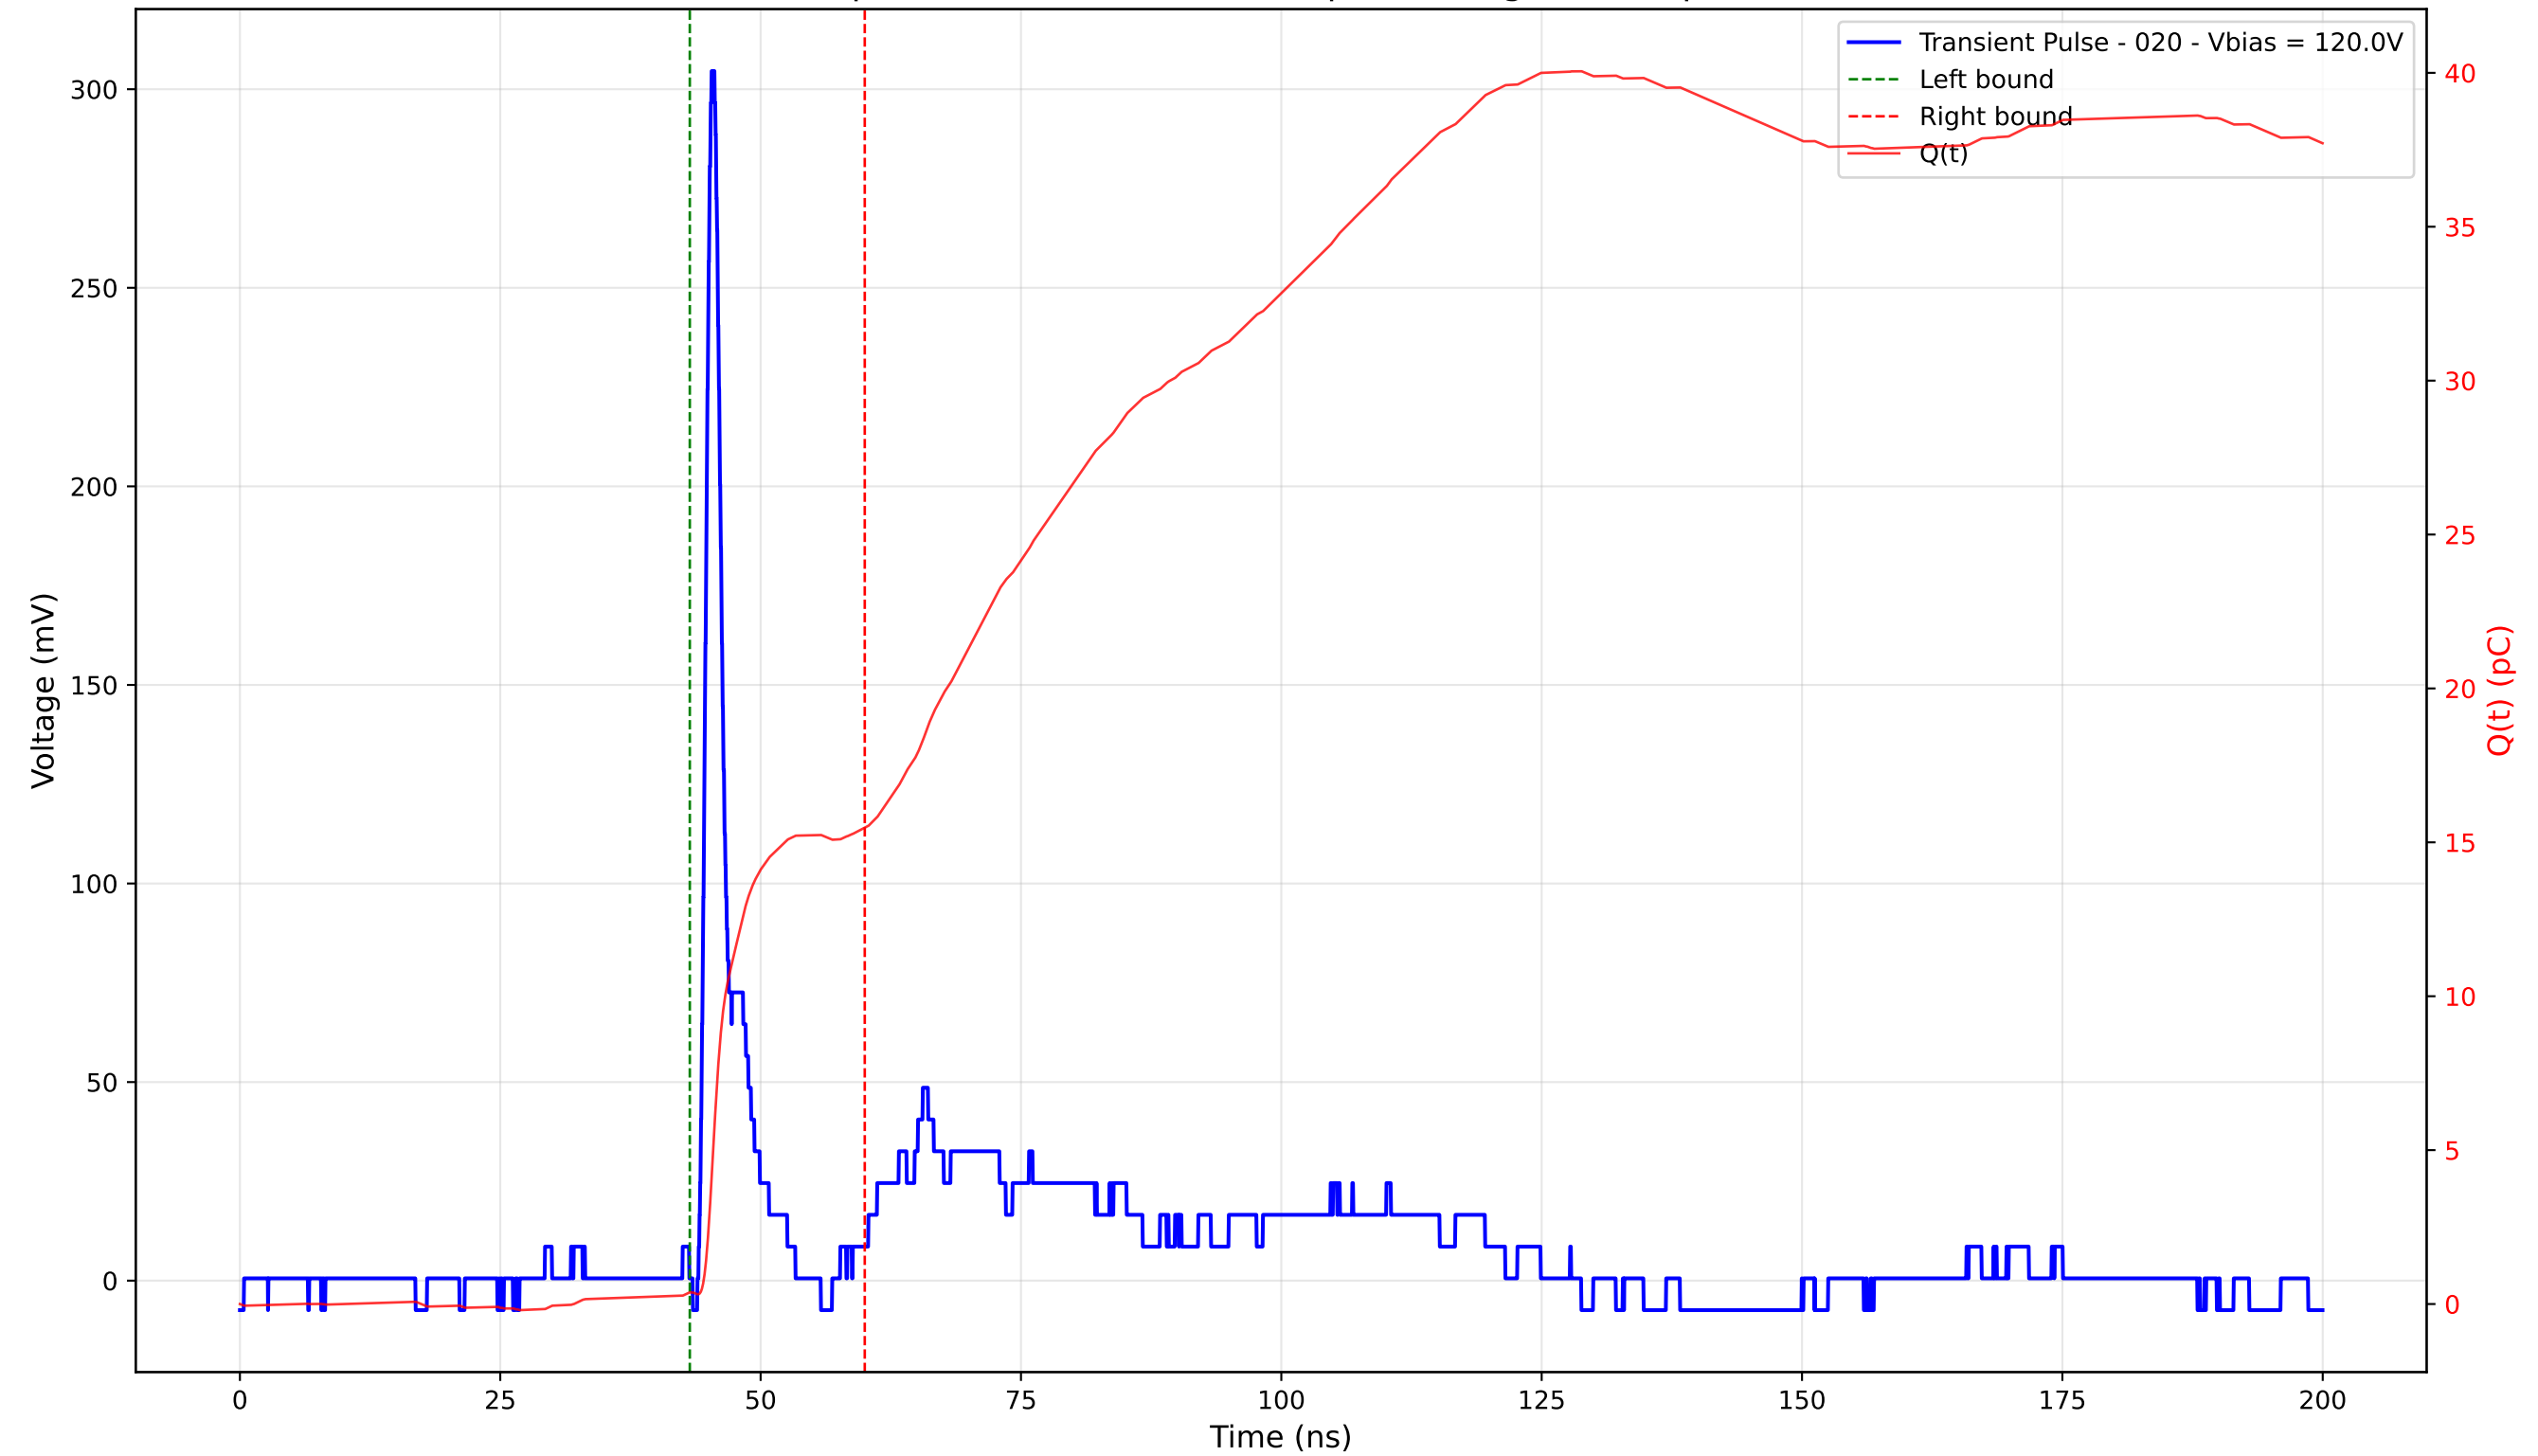


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 17.37 pC - Rise Time: 0.89 ns

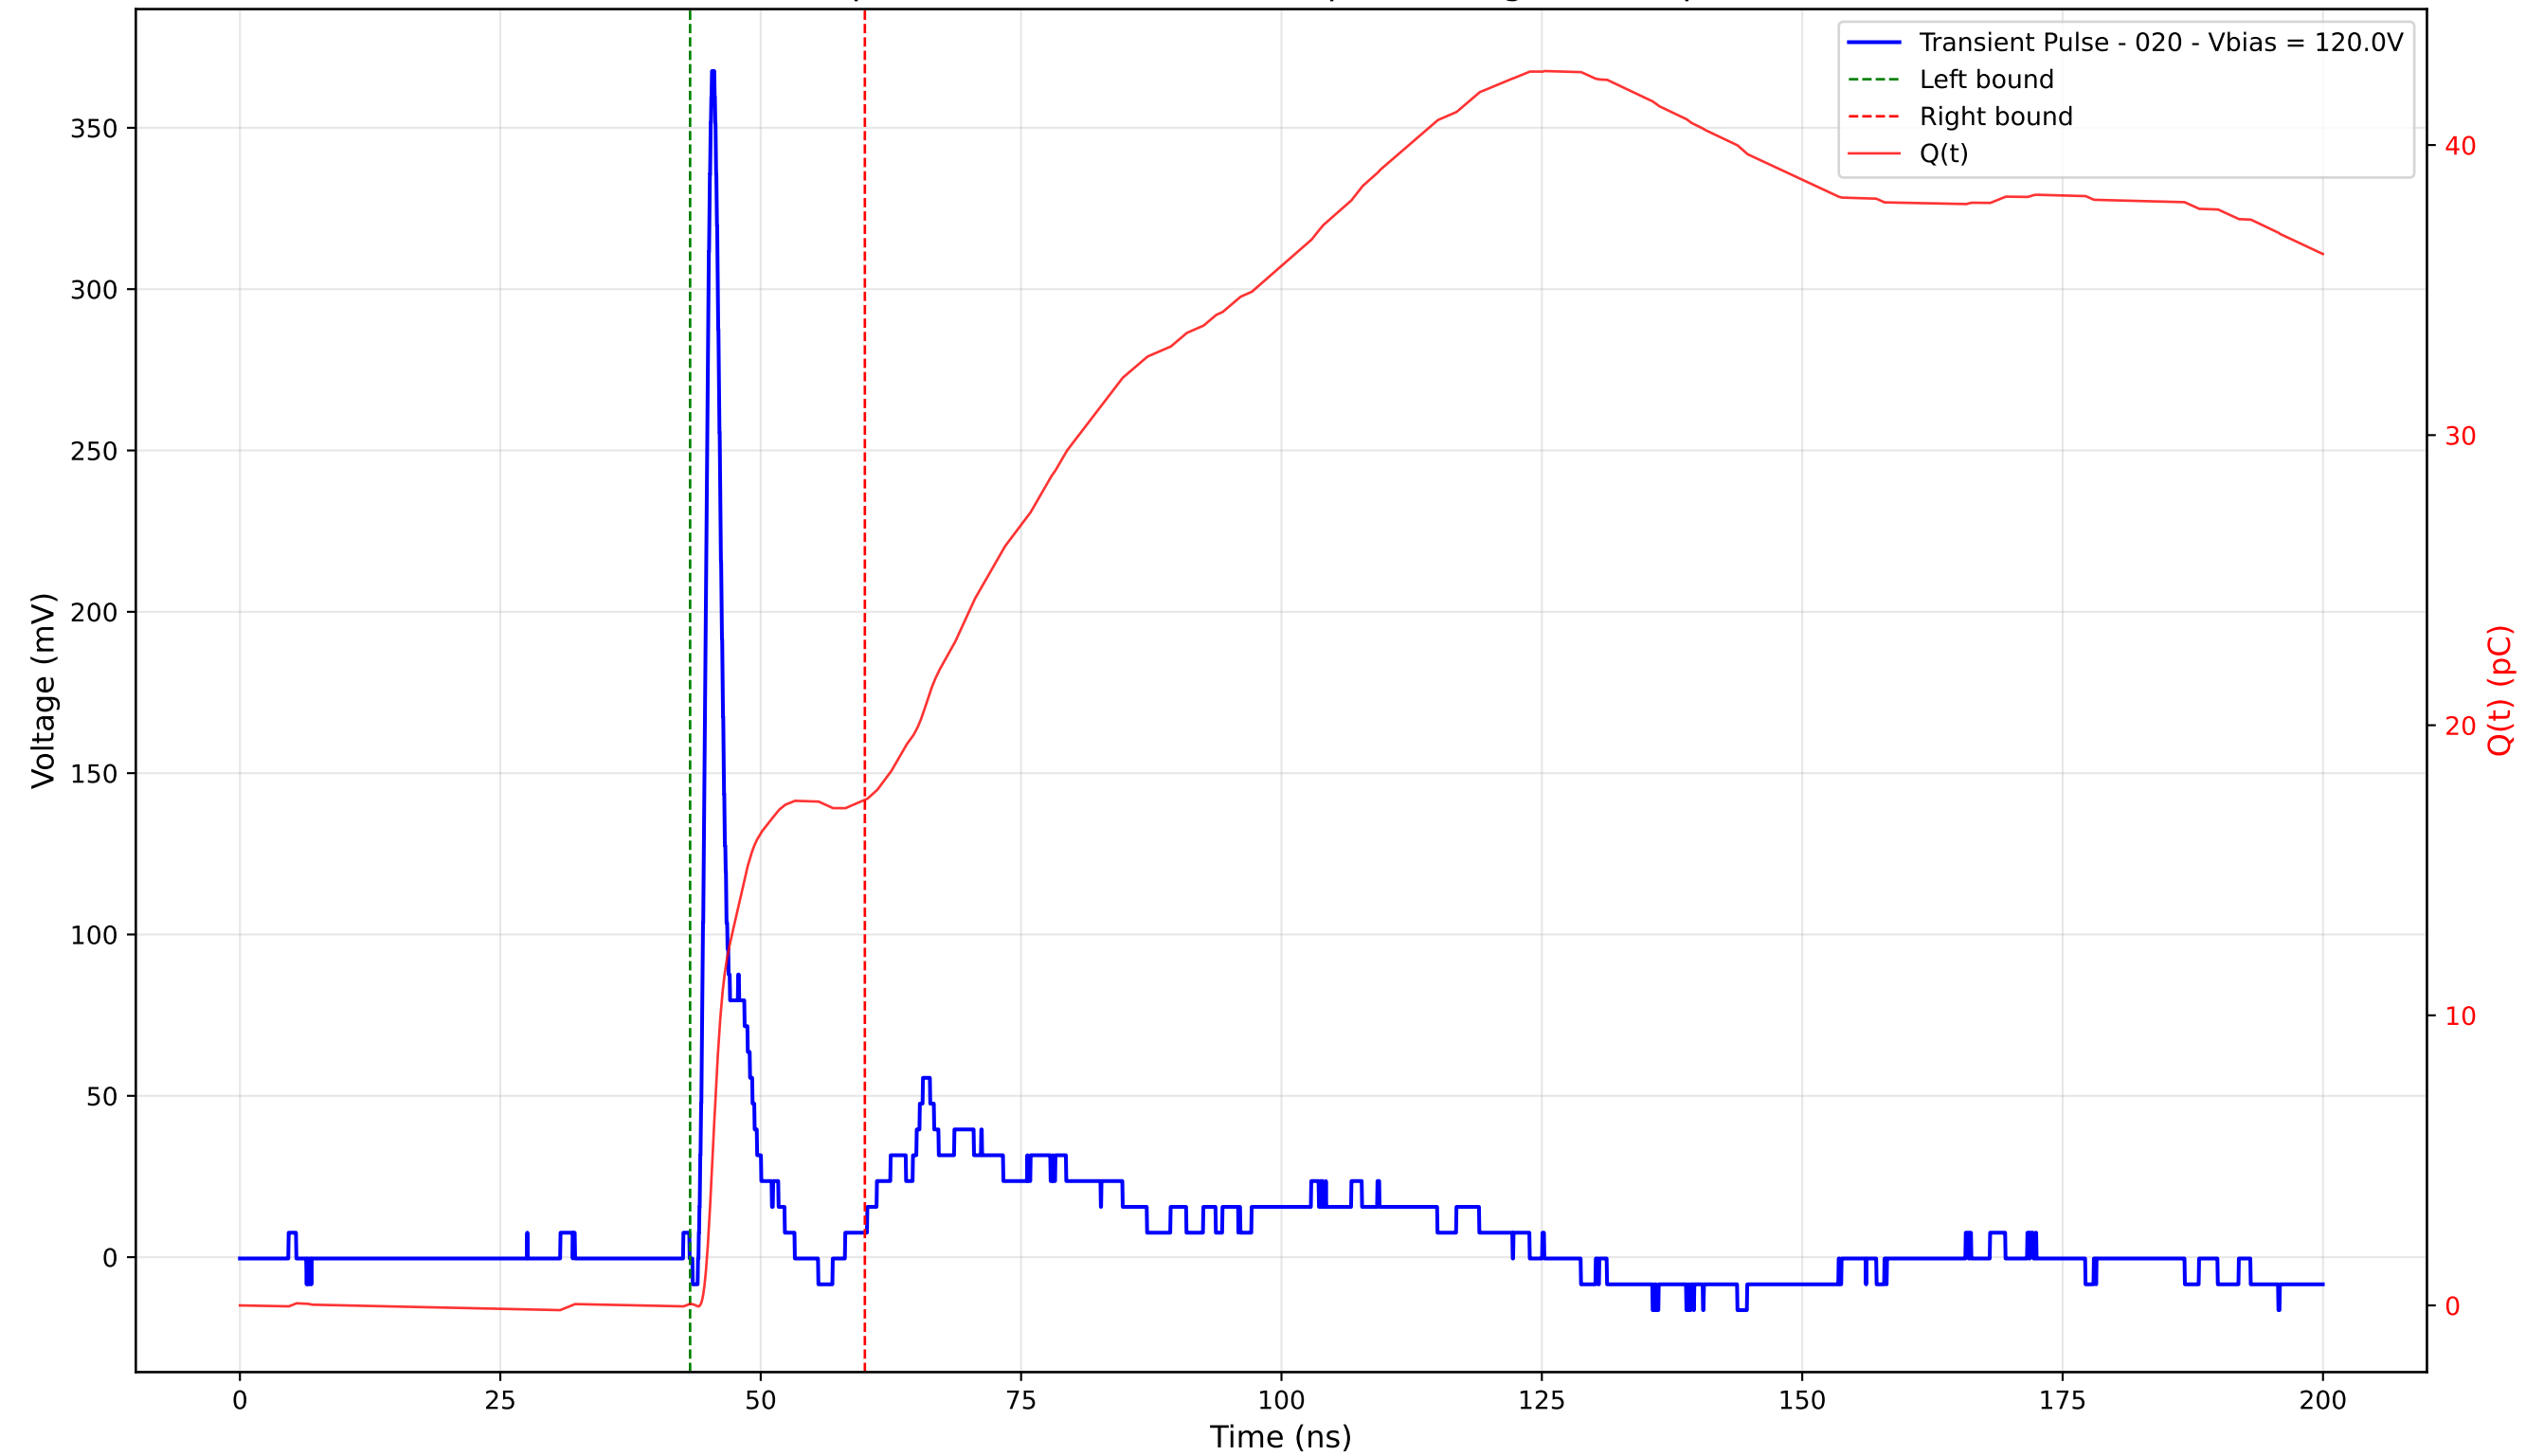


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 19.18 pC - Rise Time: 0.91 ns

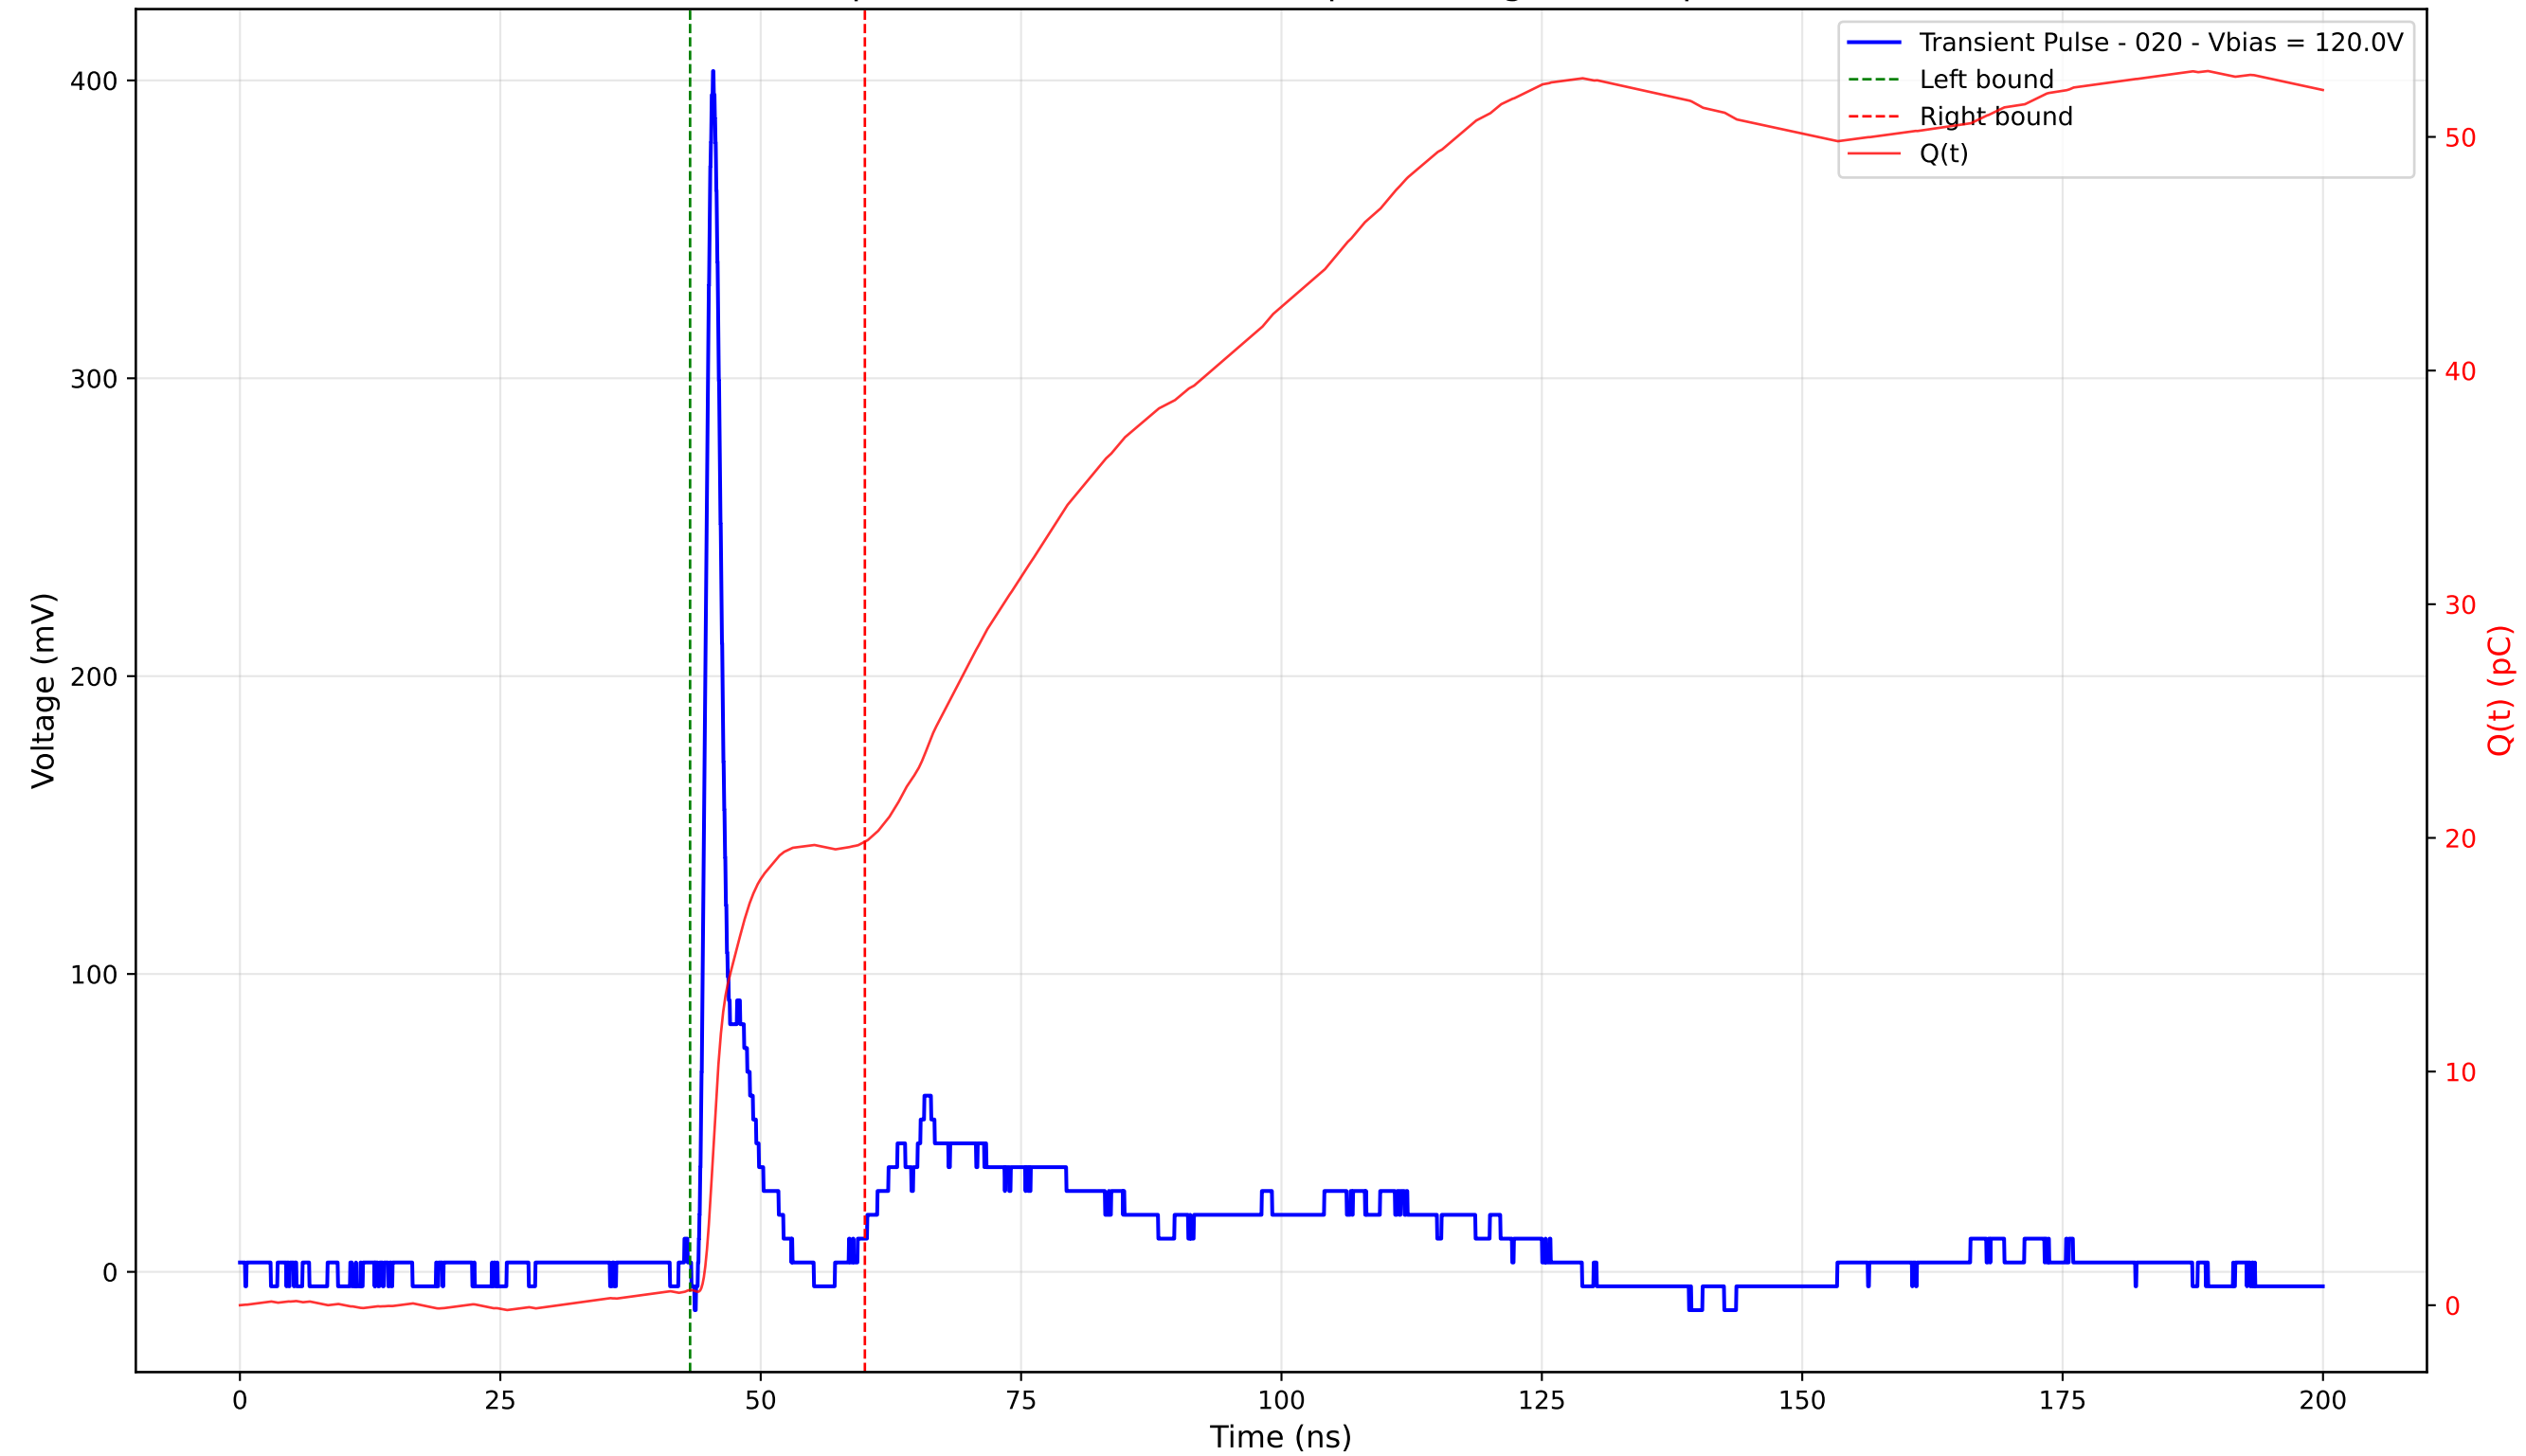


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 20.78 pC - Rise Time: 0.90 ns

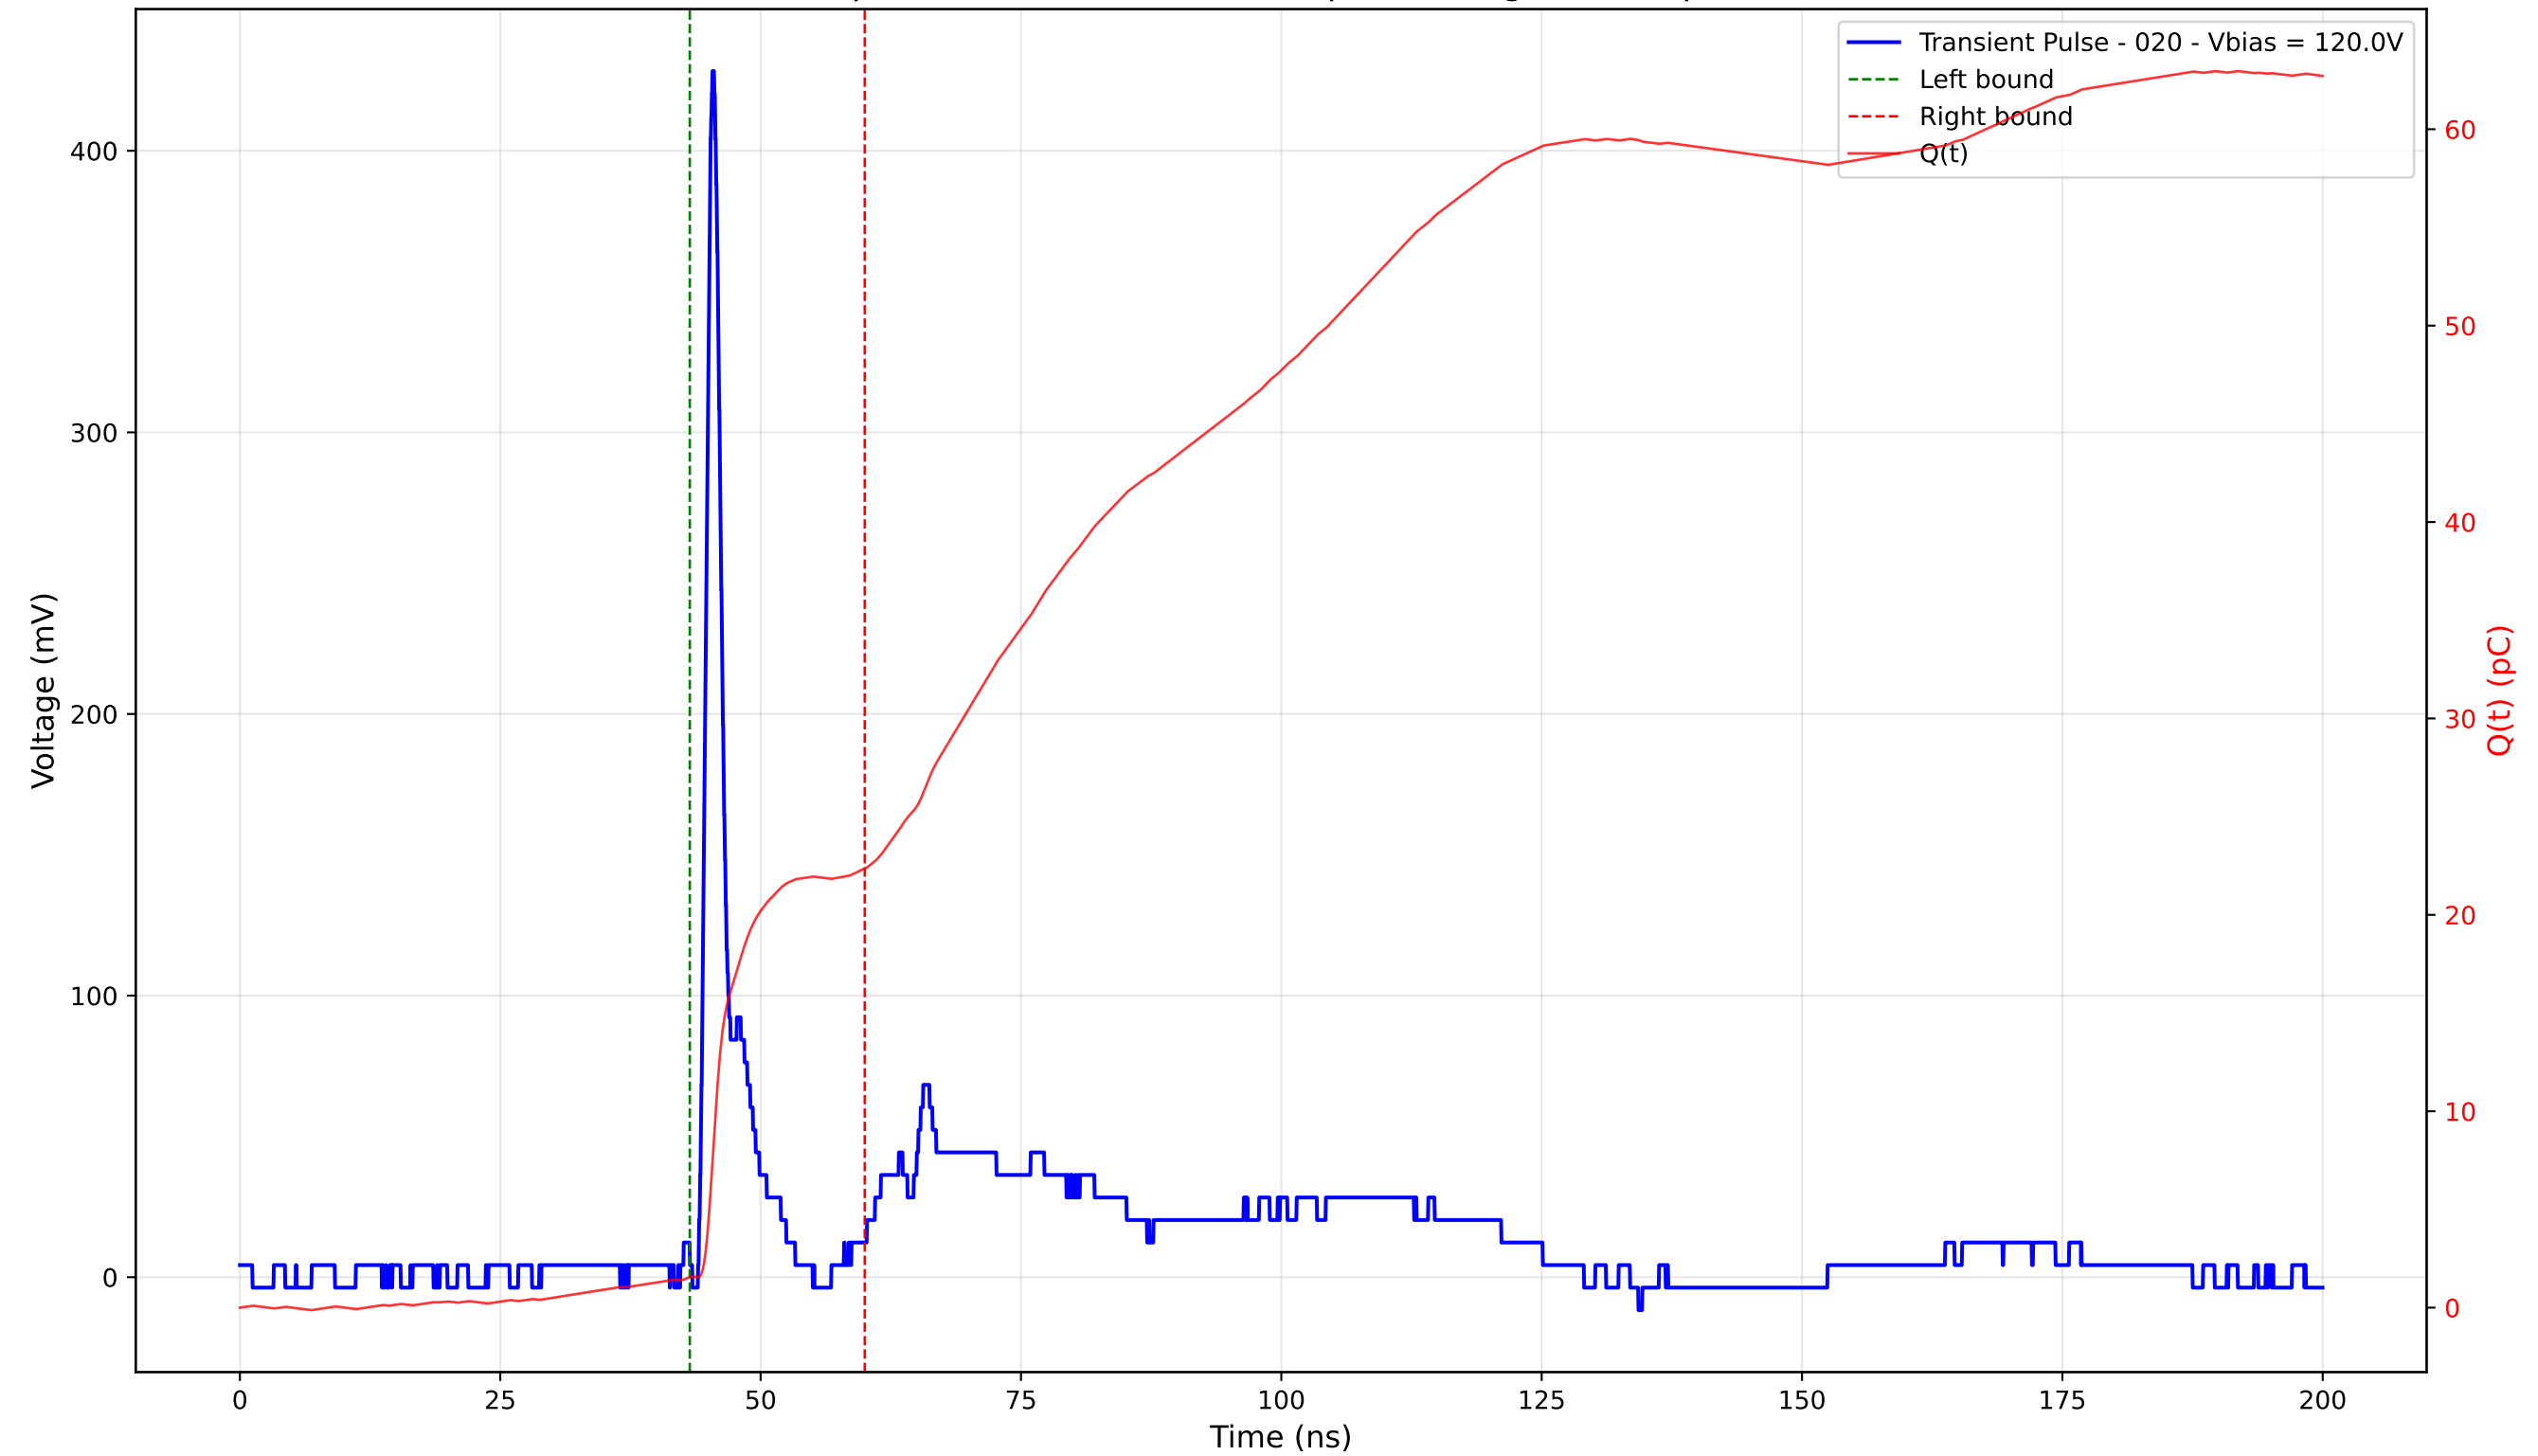


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 21.13 pC - Rise Time: 0.90 ns

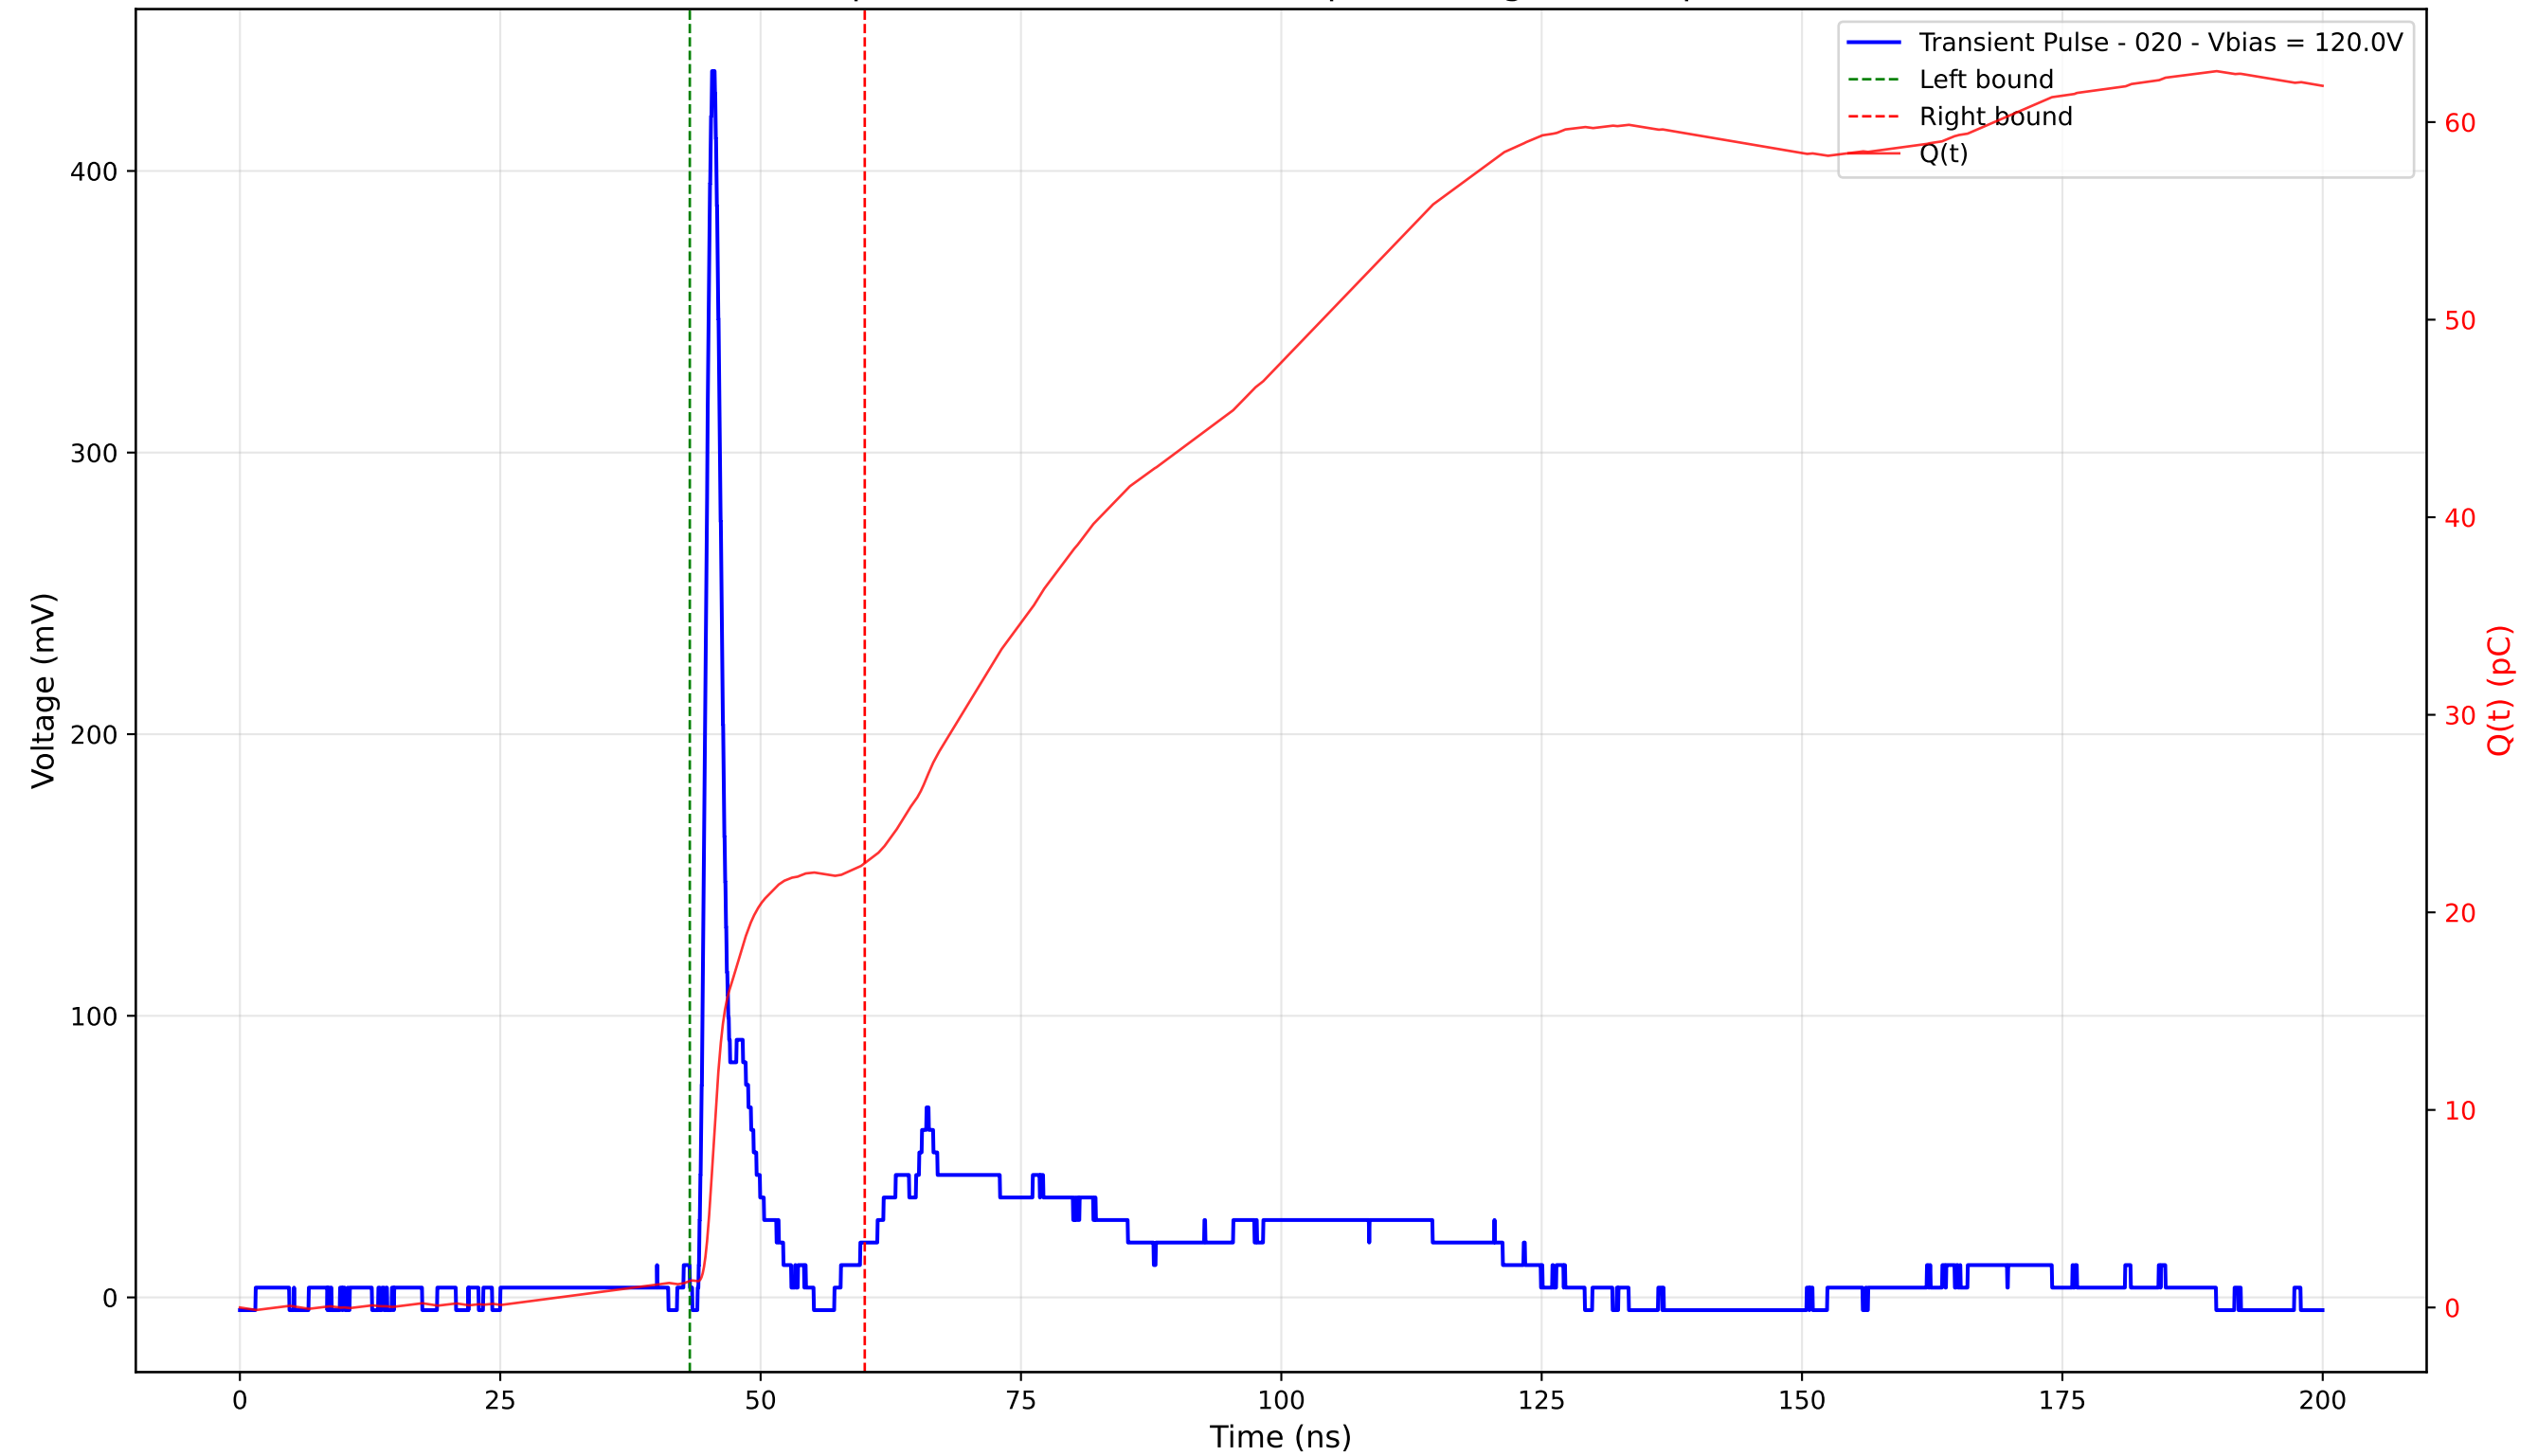


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 20.39 pC - Rise Time: 0.92 ns

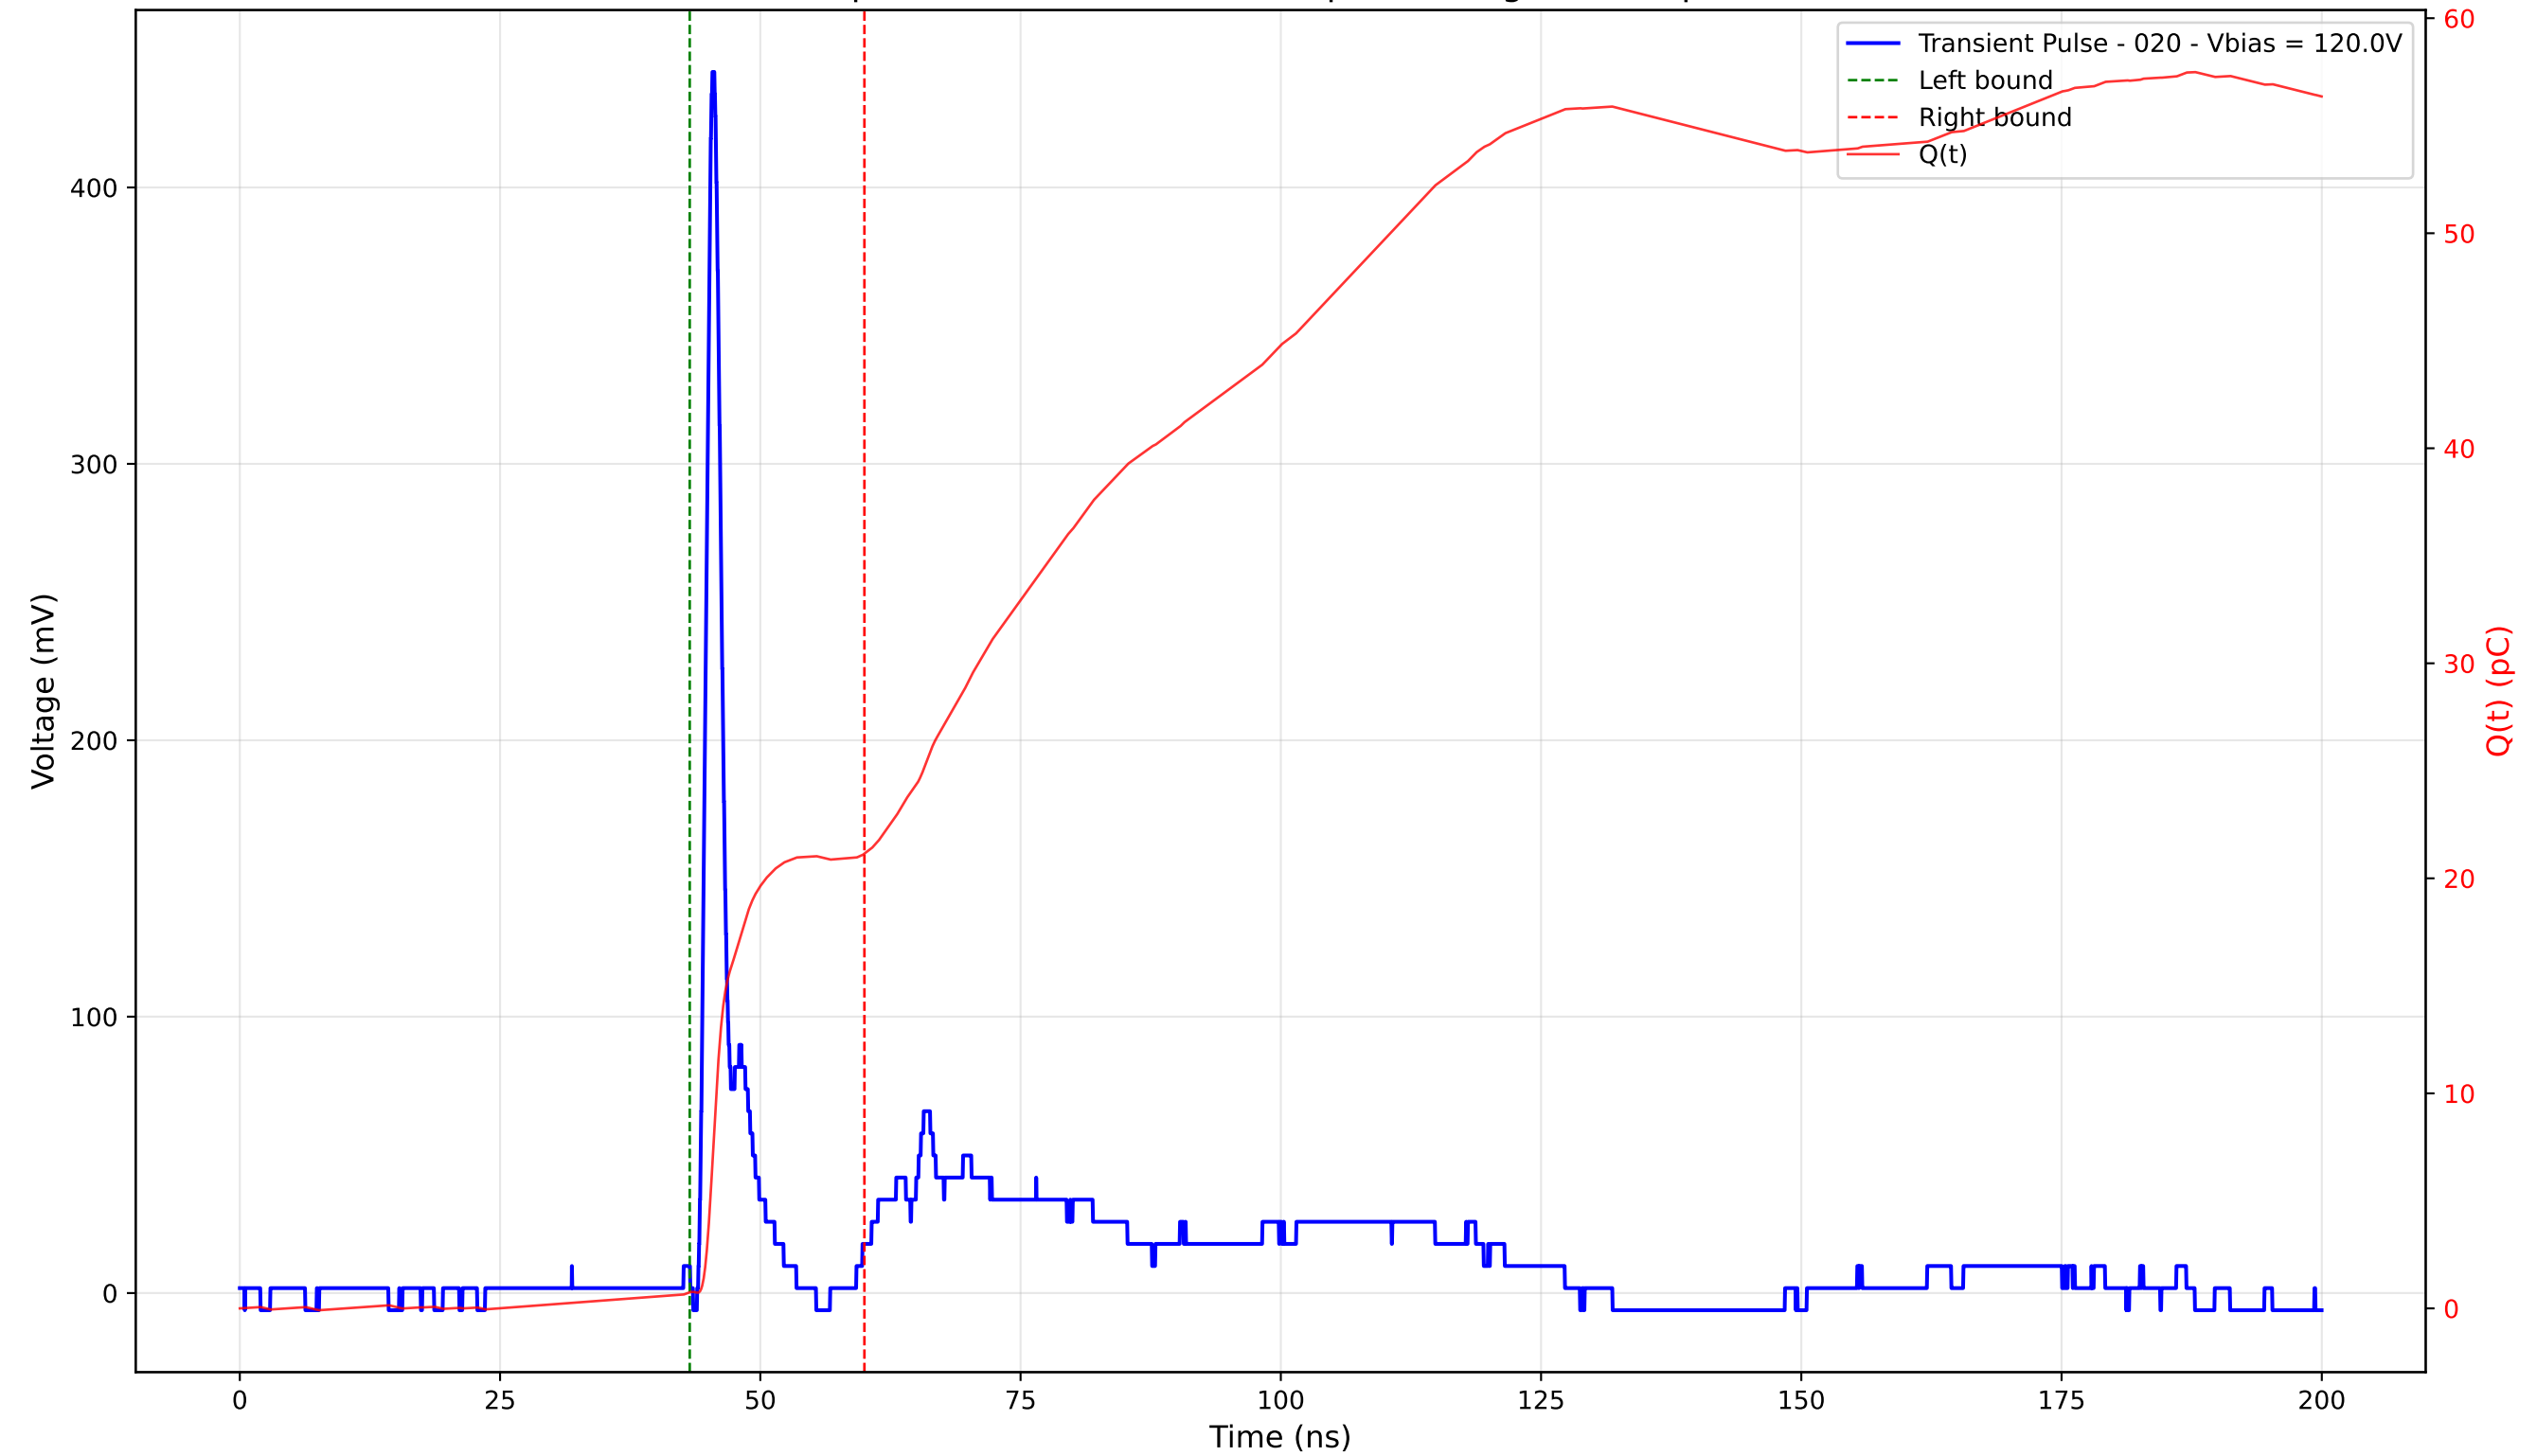


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 20.78 pC - Rise Time: 0.91 ns

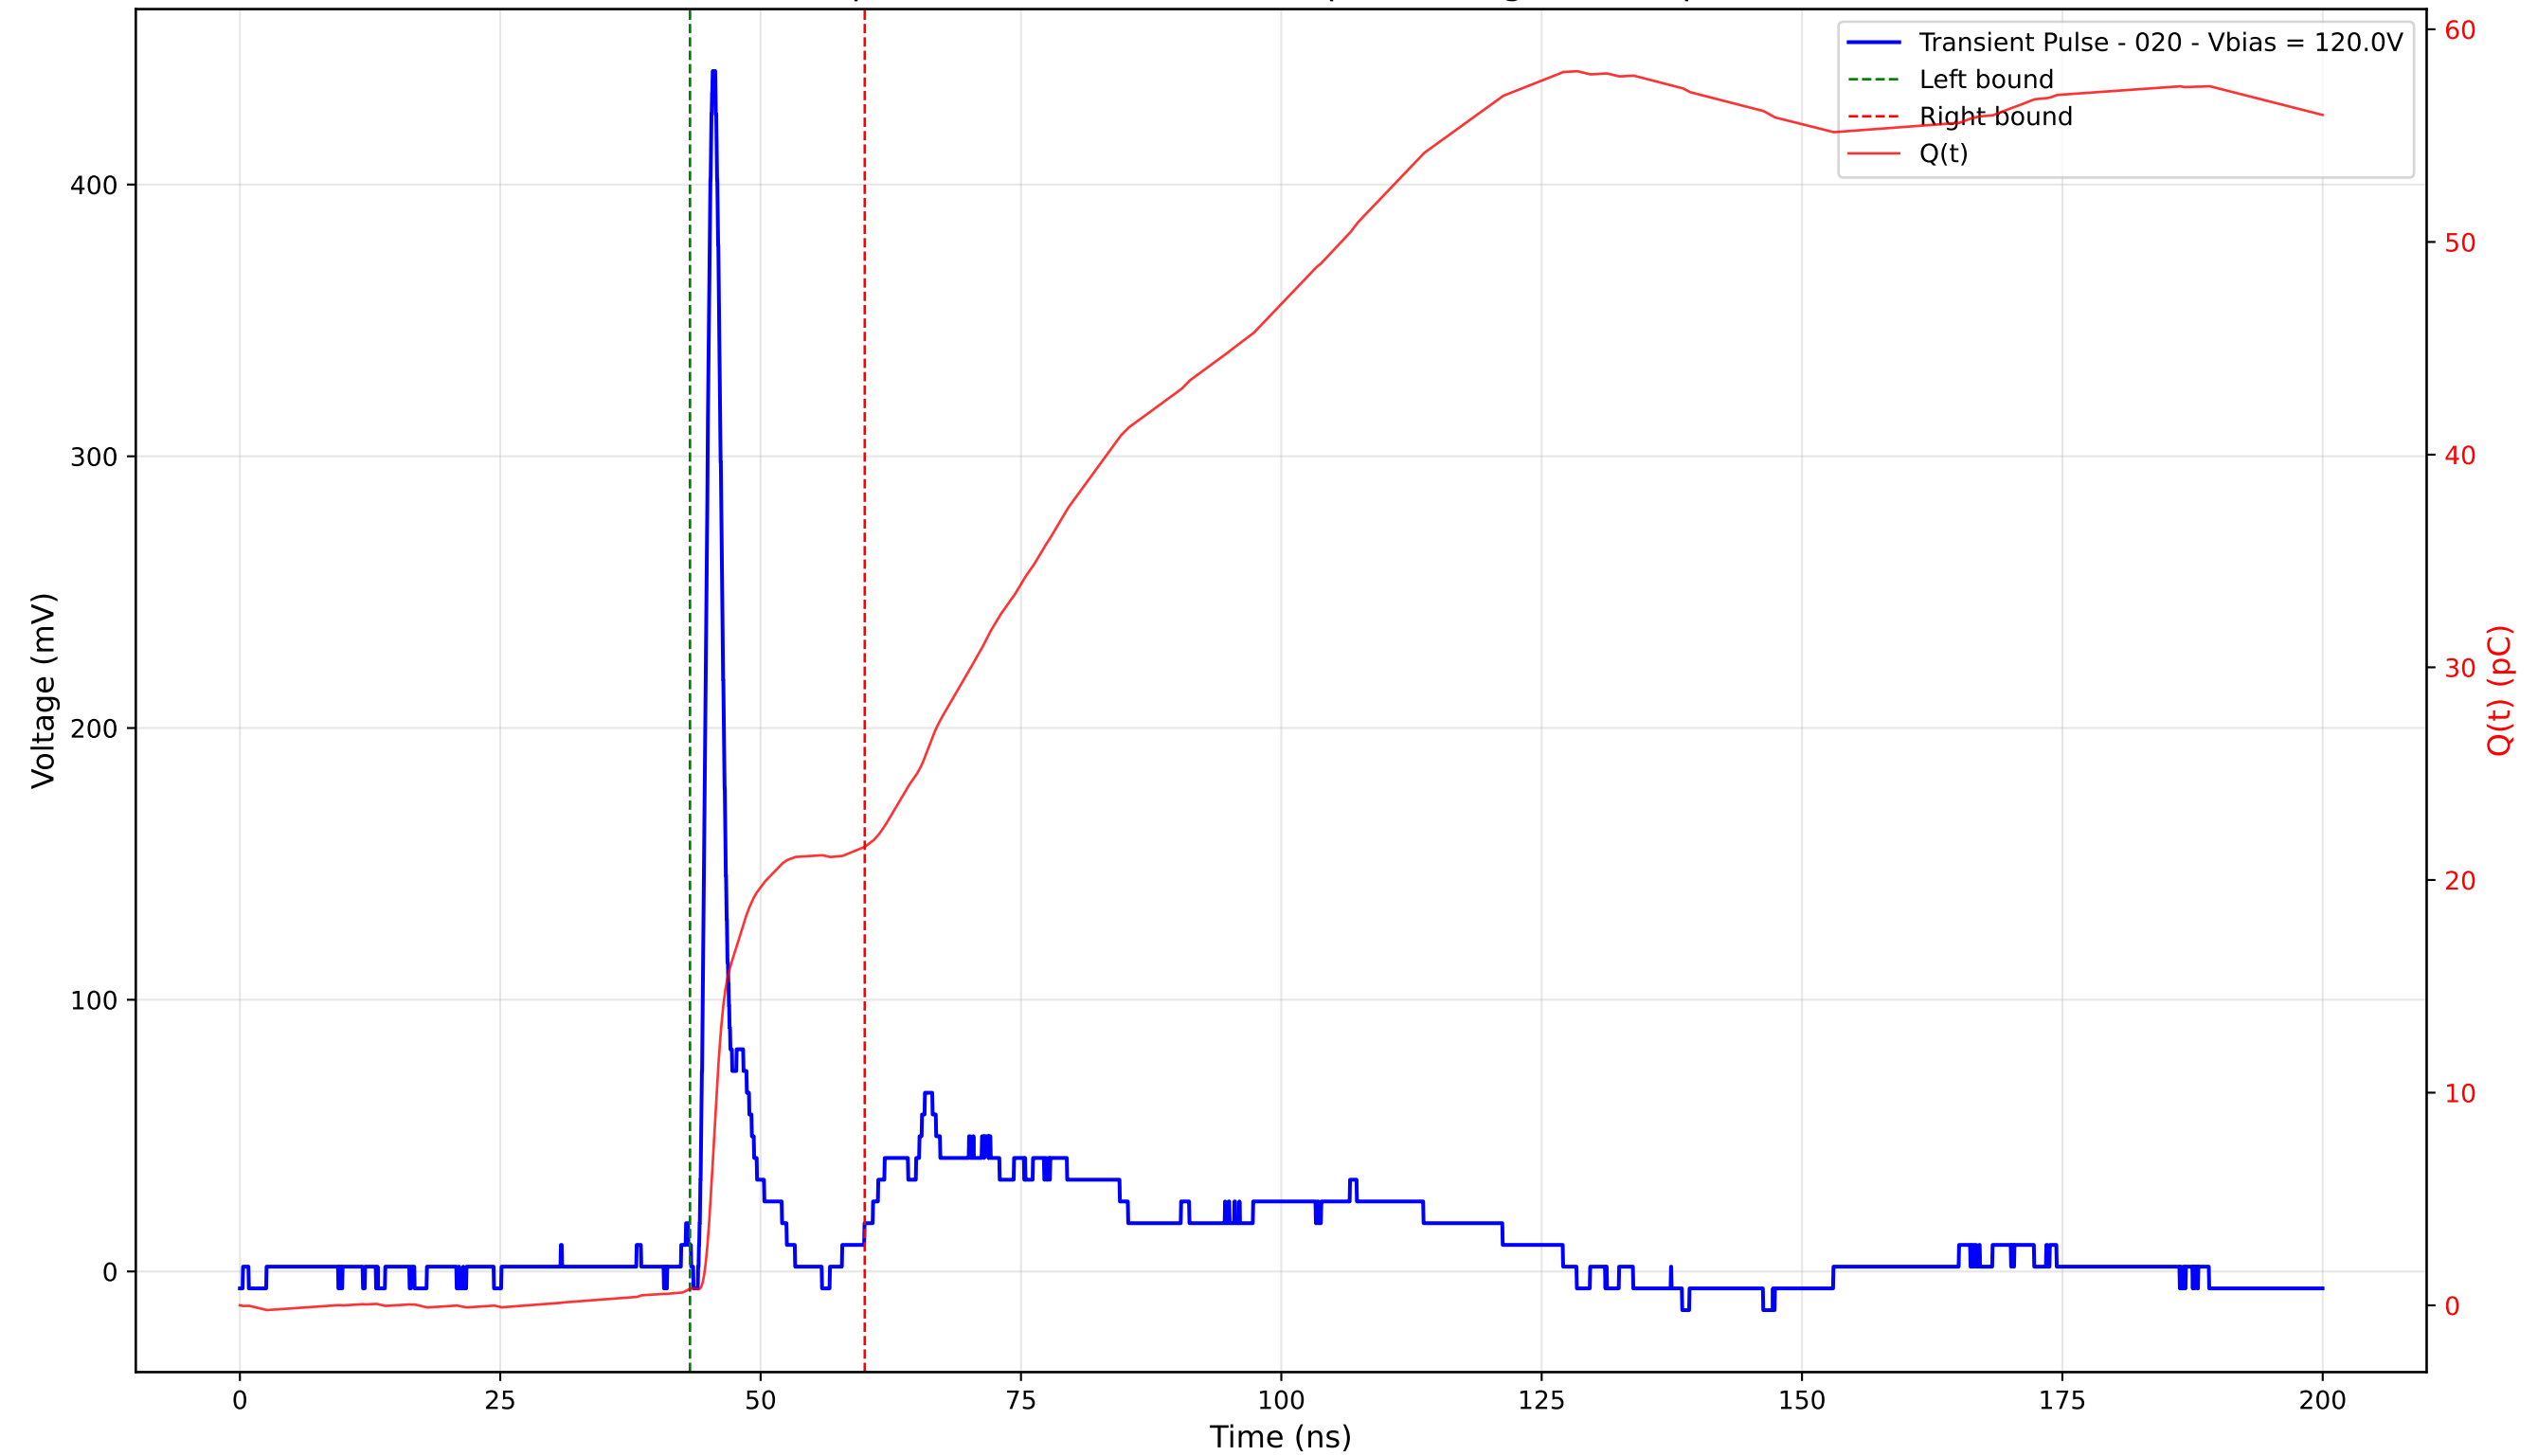


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 20.49 pC - Rise Time: 0.96 ns

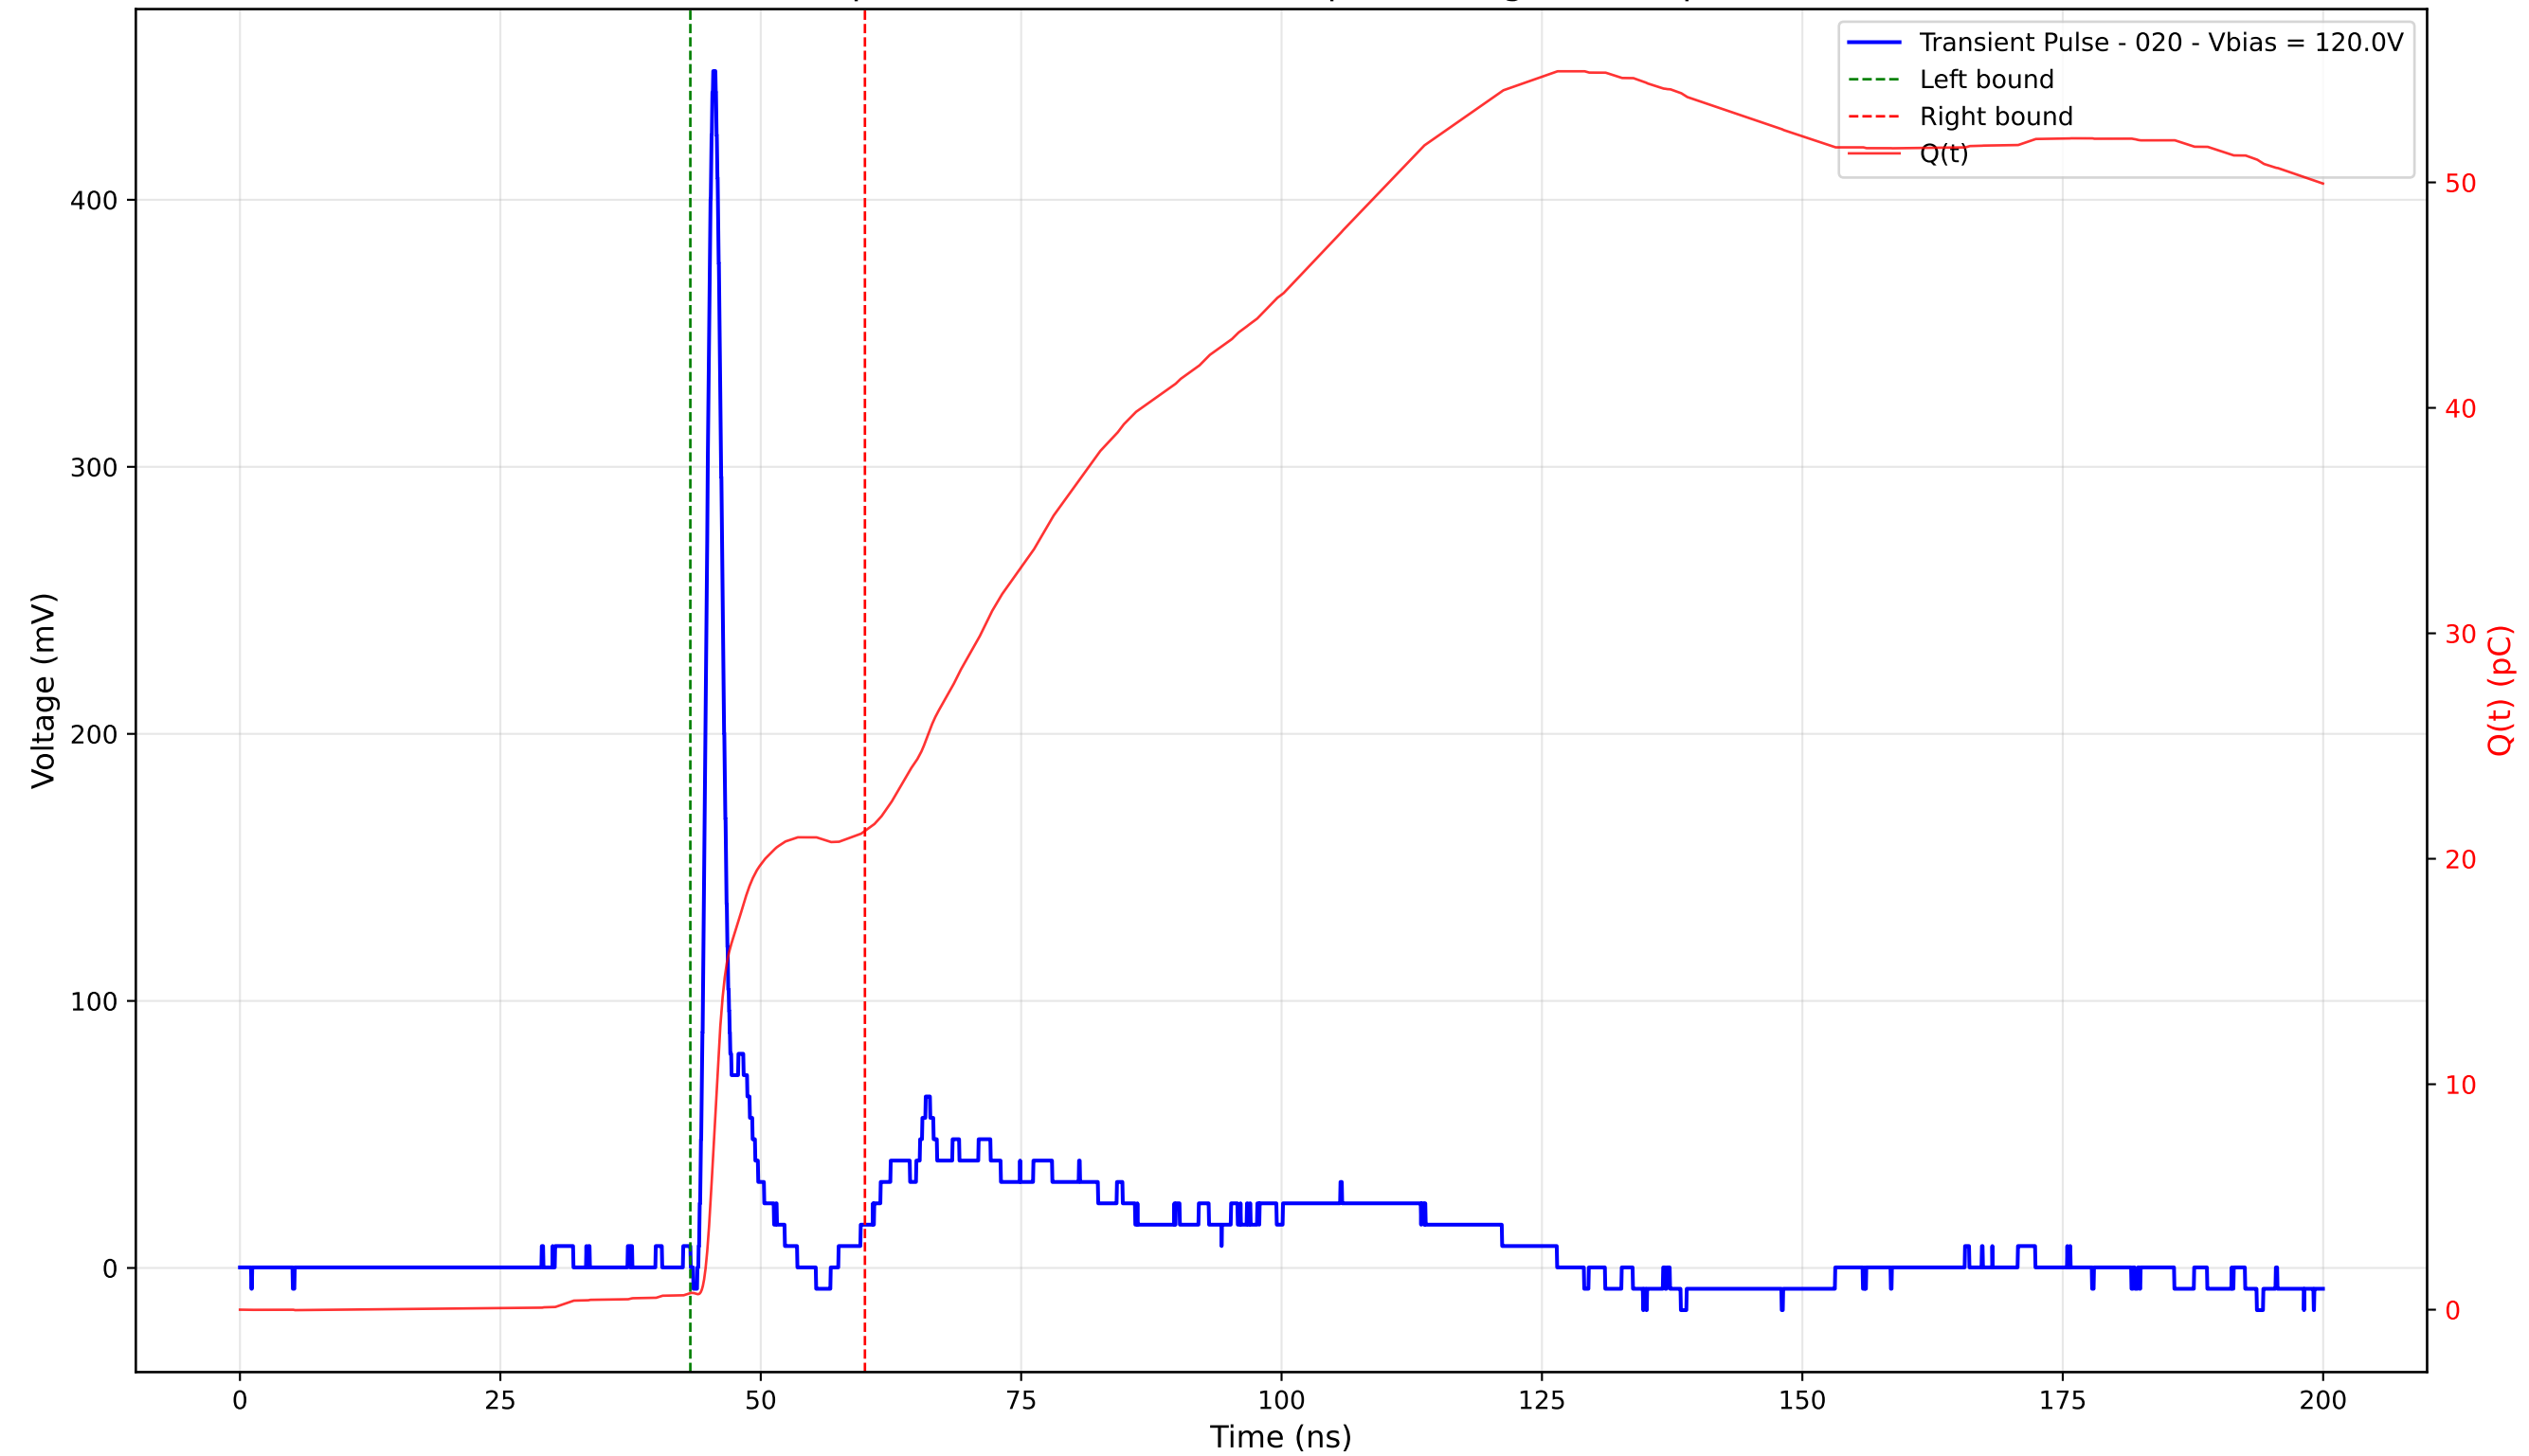


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 19.86 pC - Rise Time: 0.97 ns

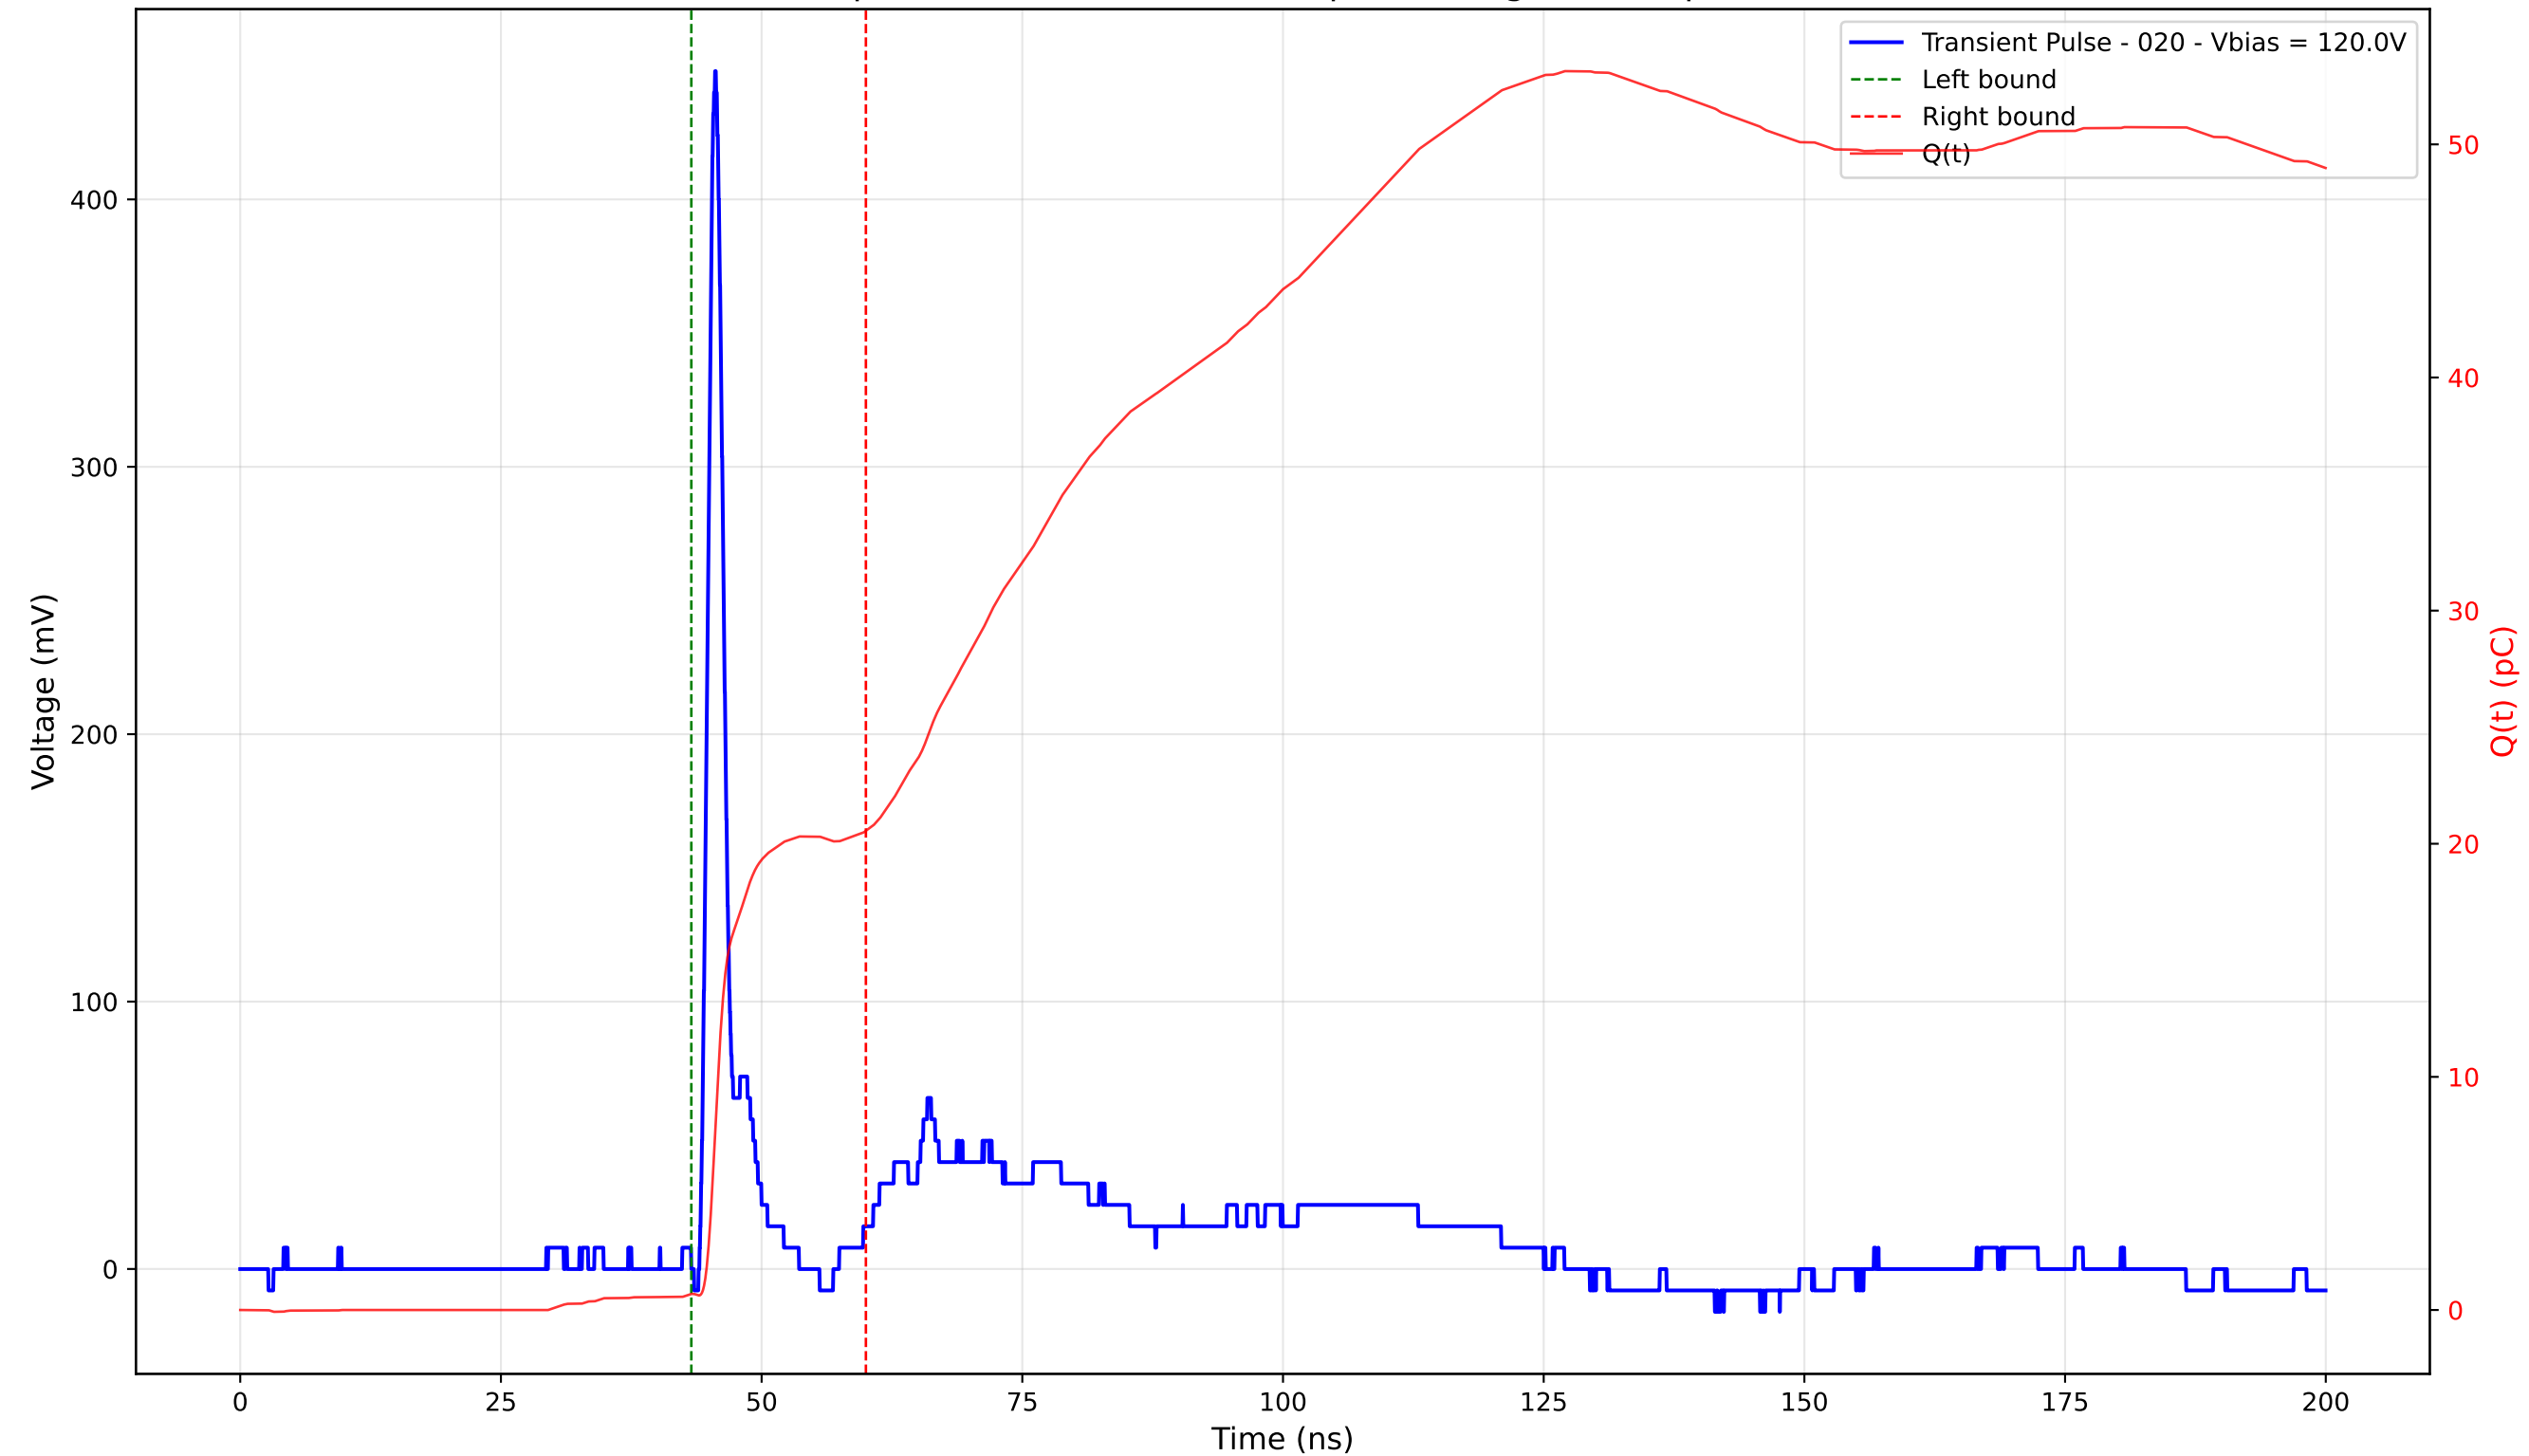


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 20.00 pC - Rise Time: 0.97 ns

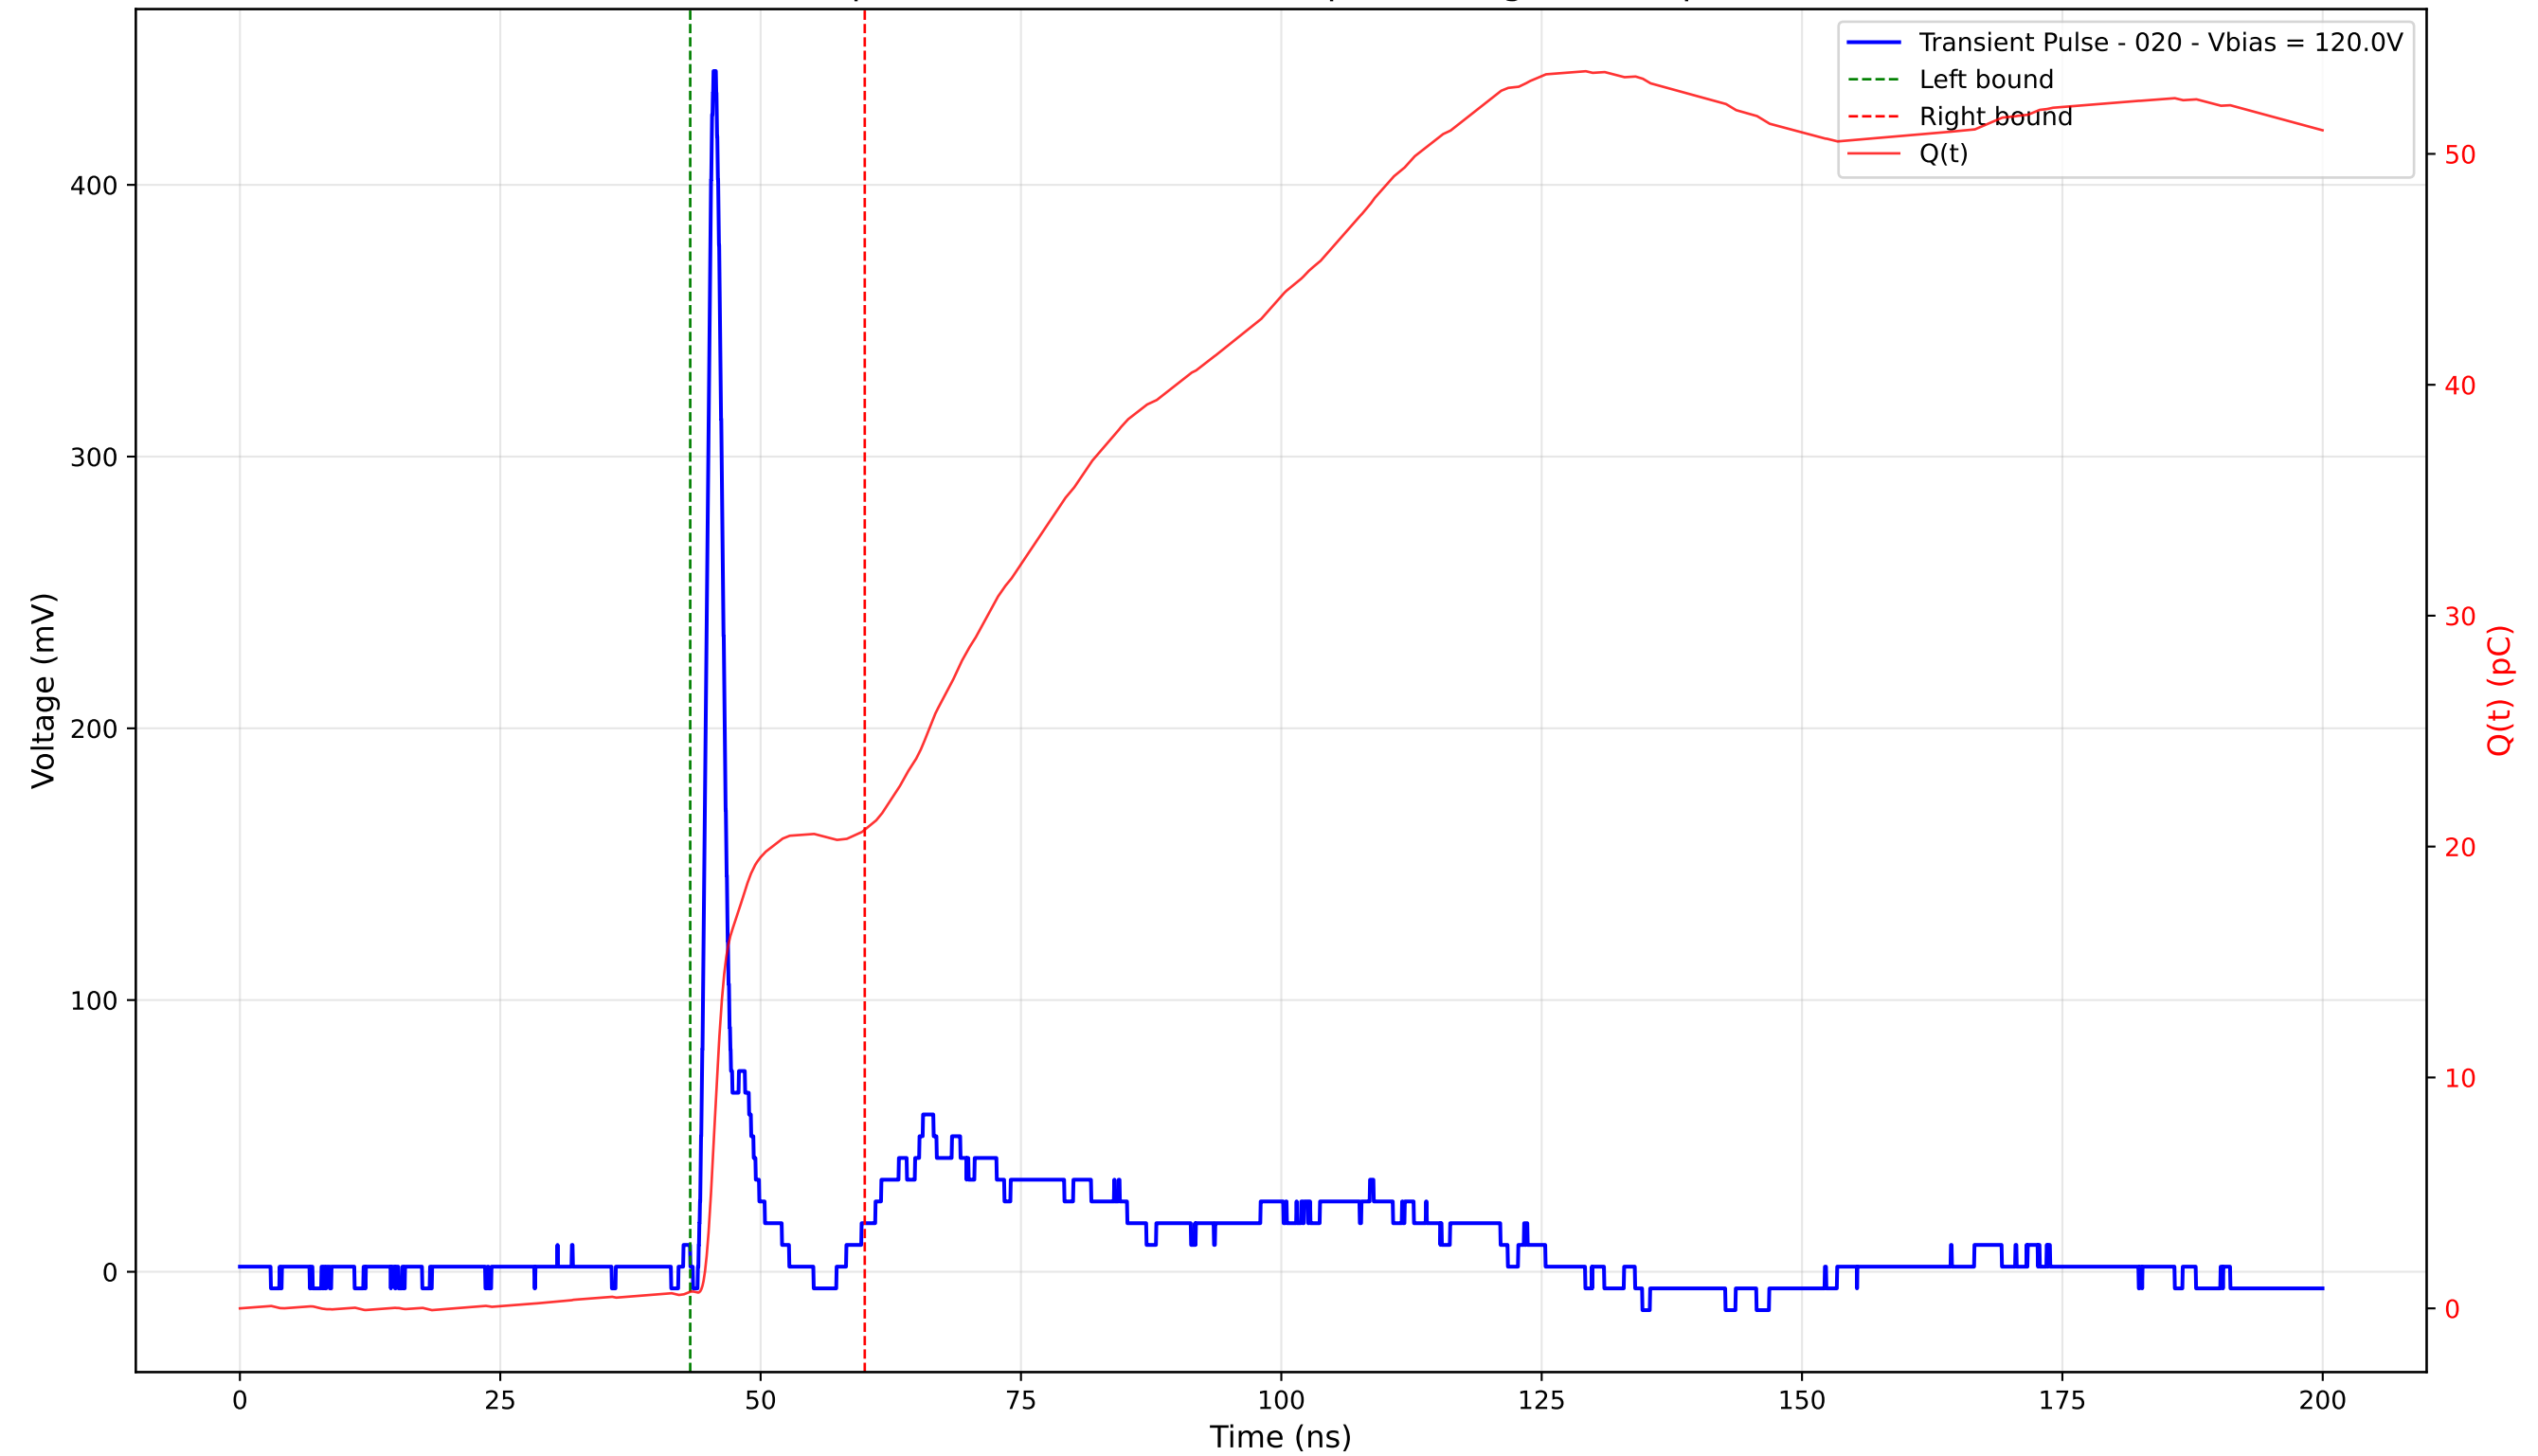


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 20.41 pC - Rise Time: 1.00 ns

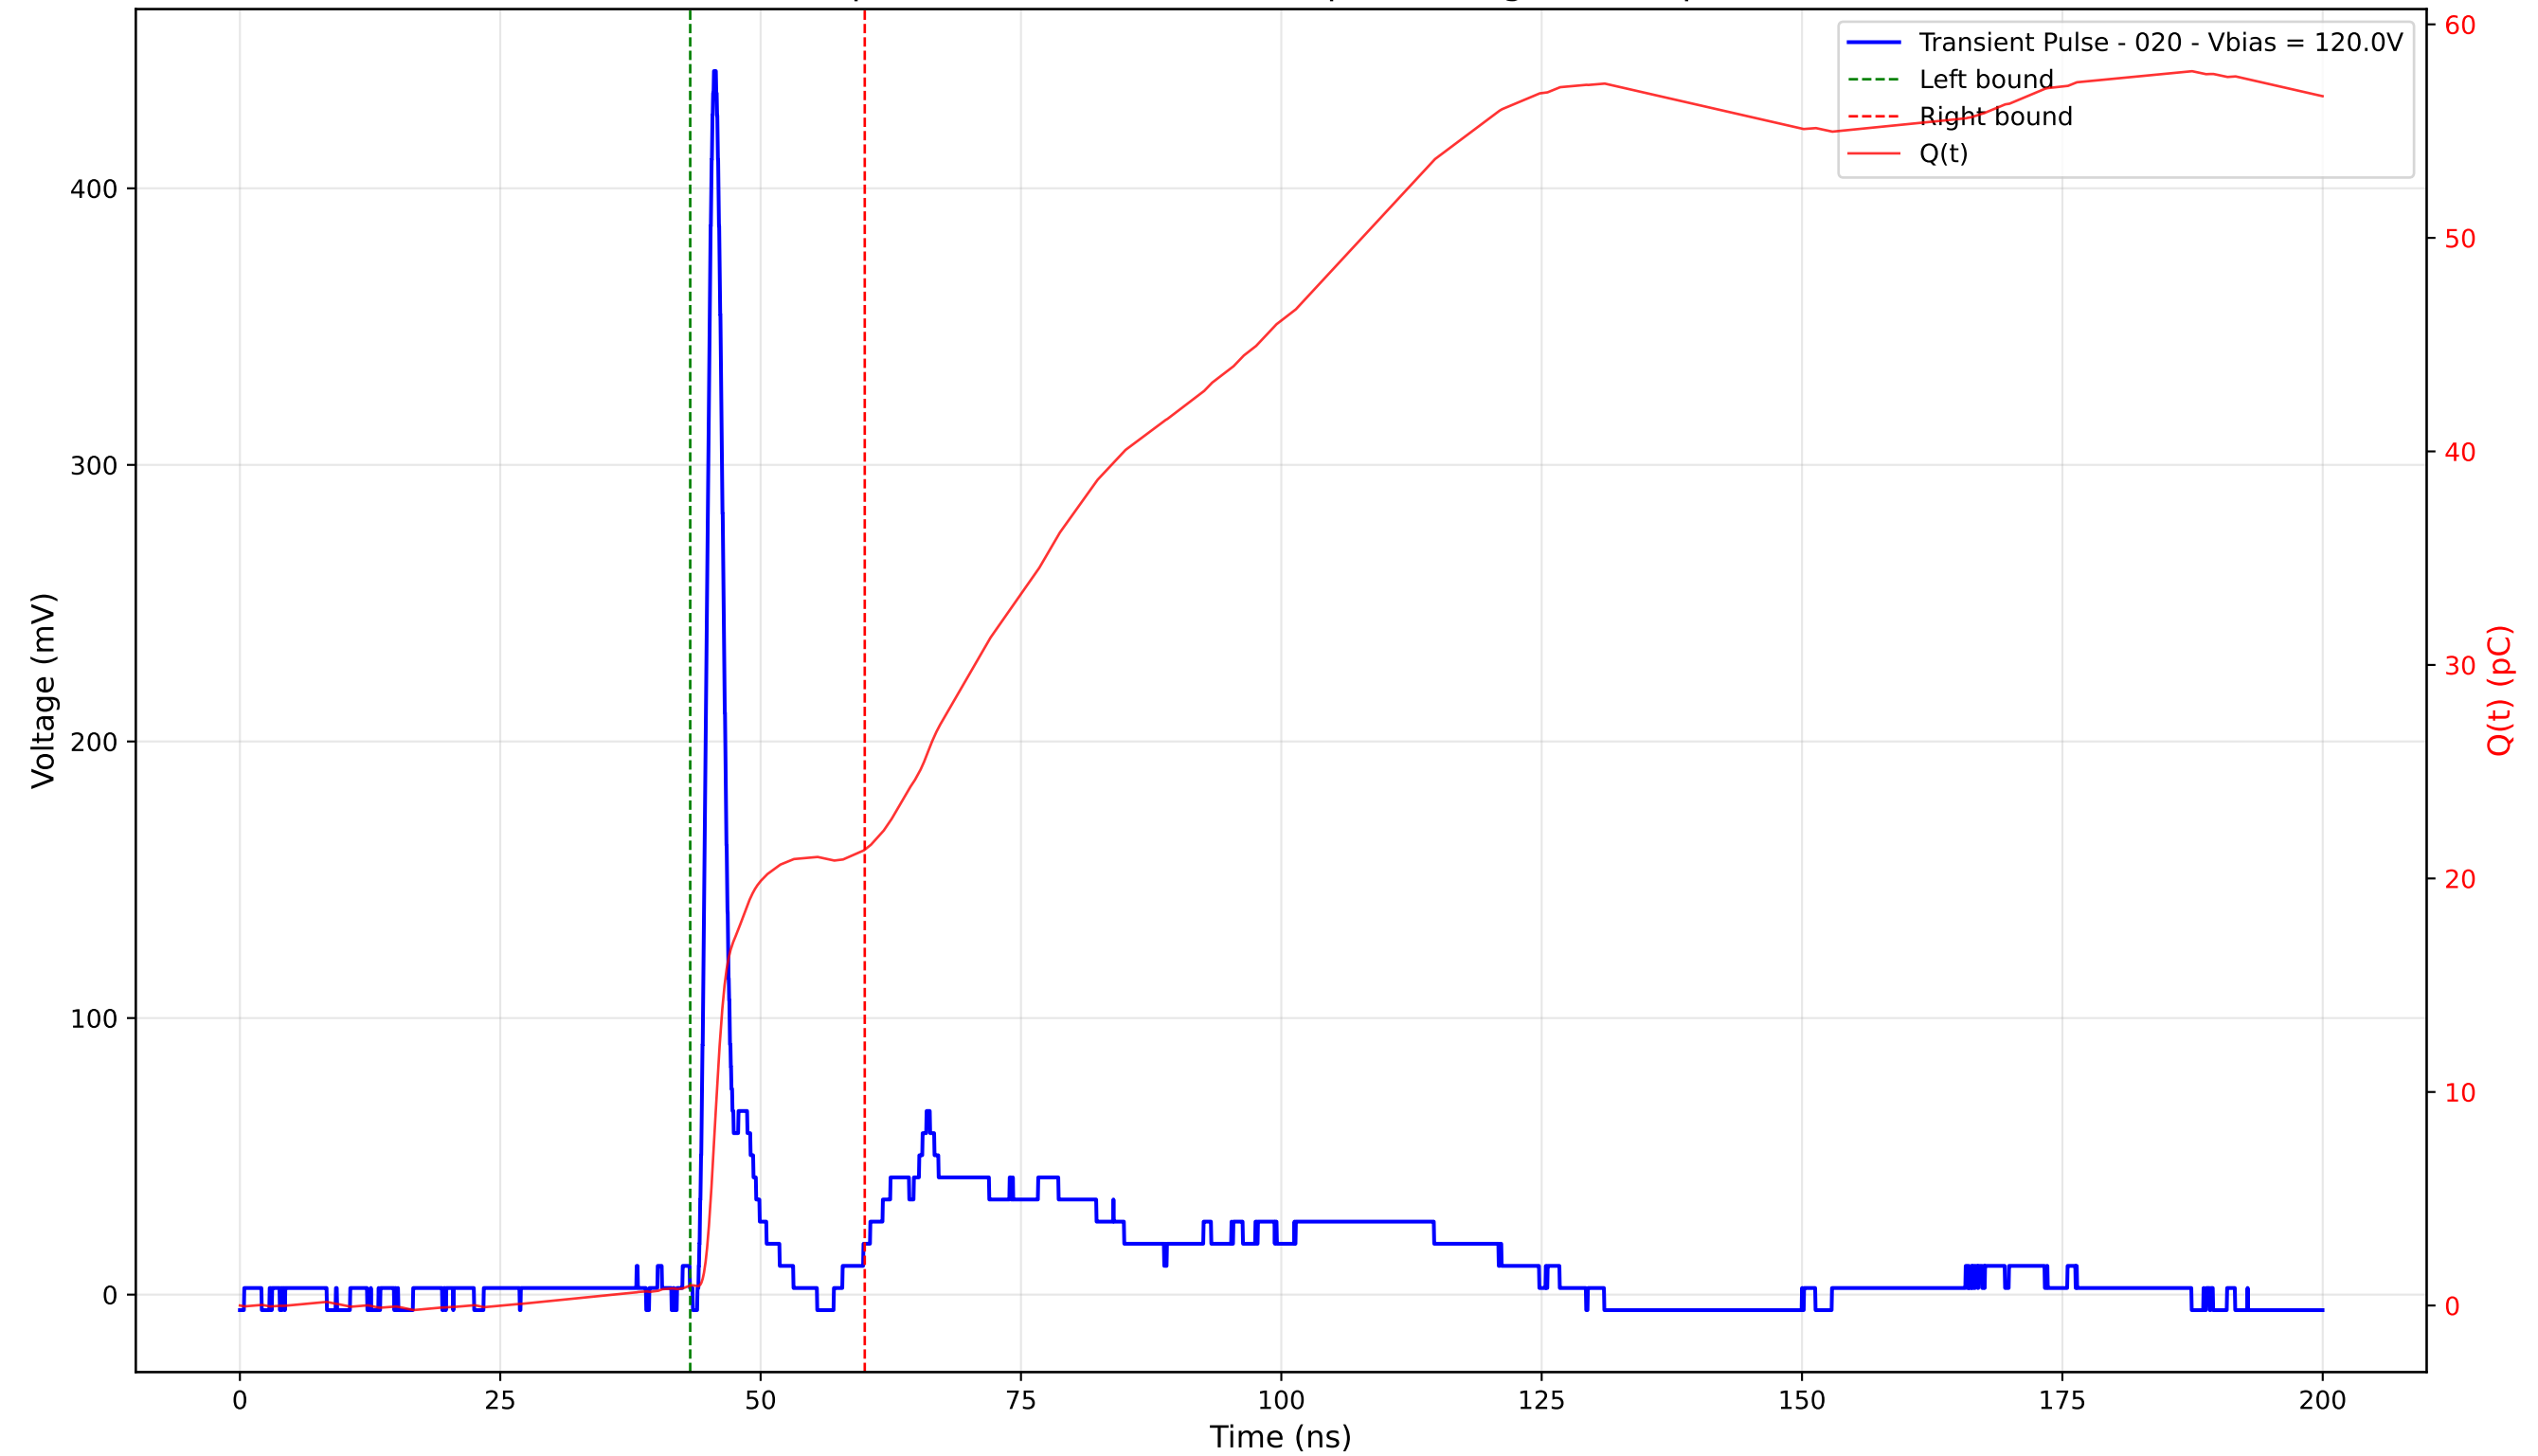


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 20.12 pC - Rise Time: 1.01 ns

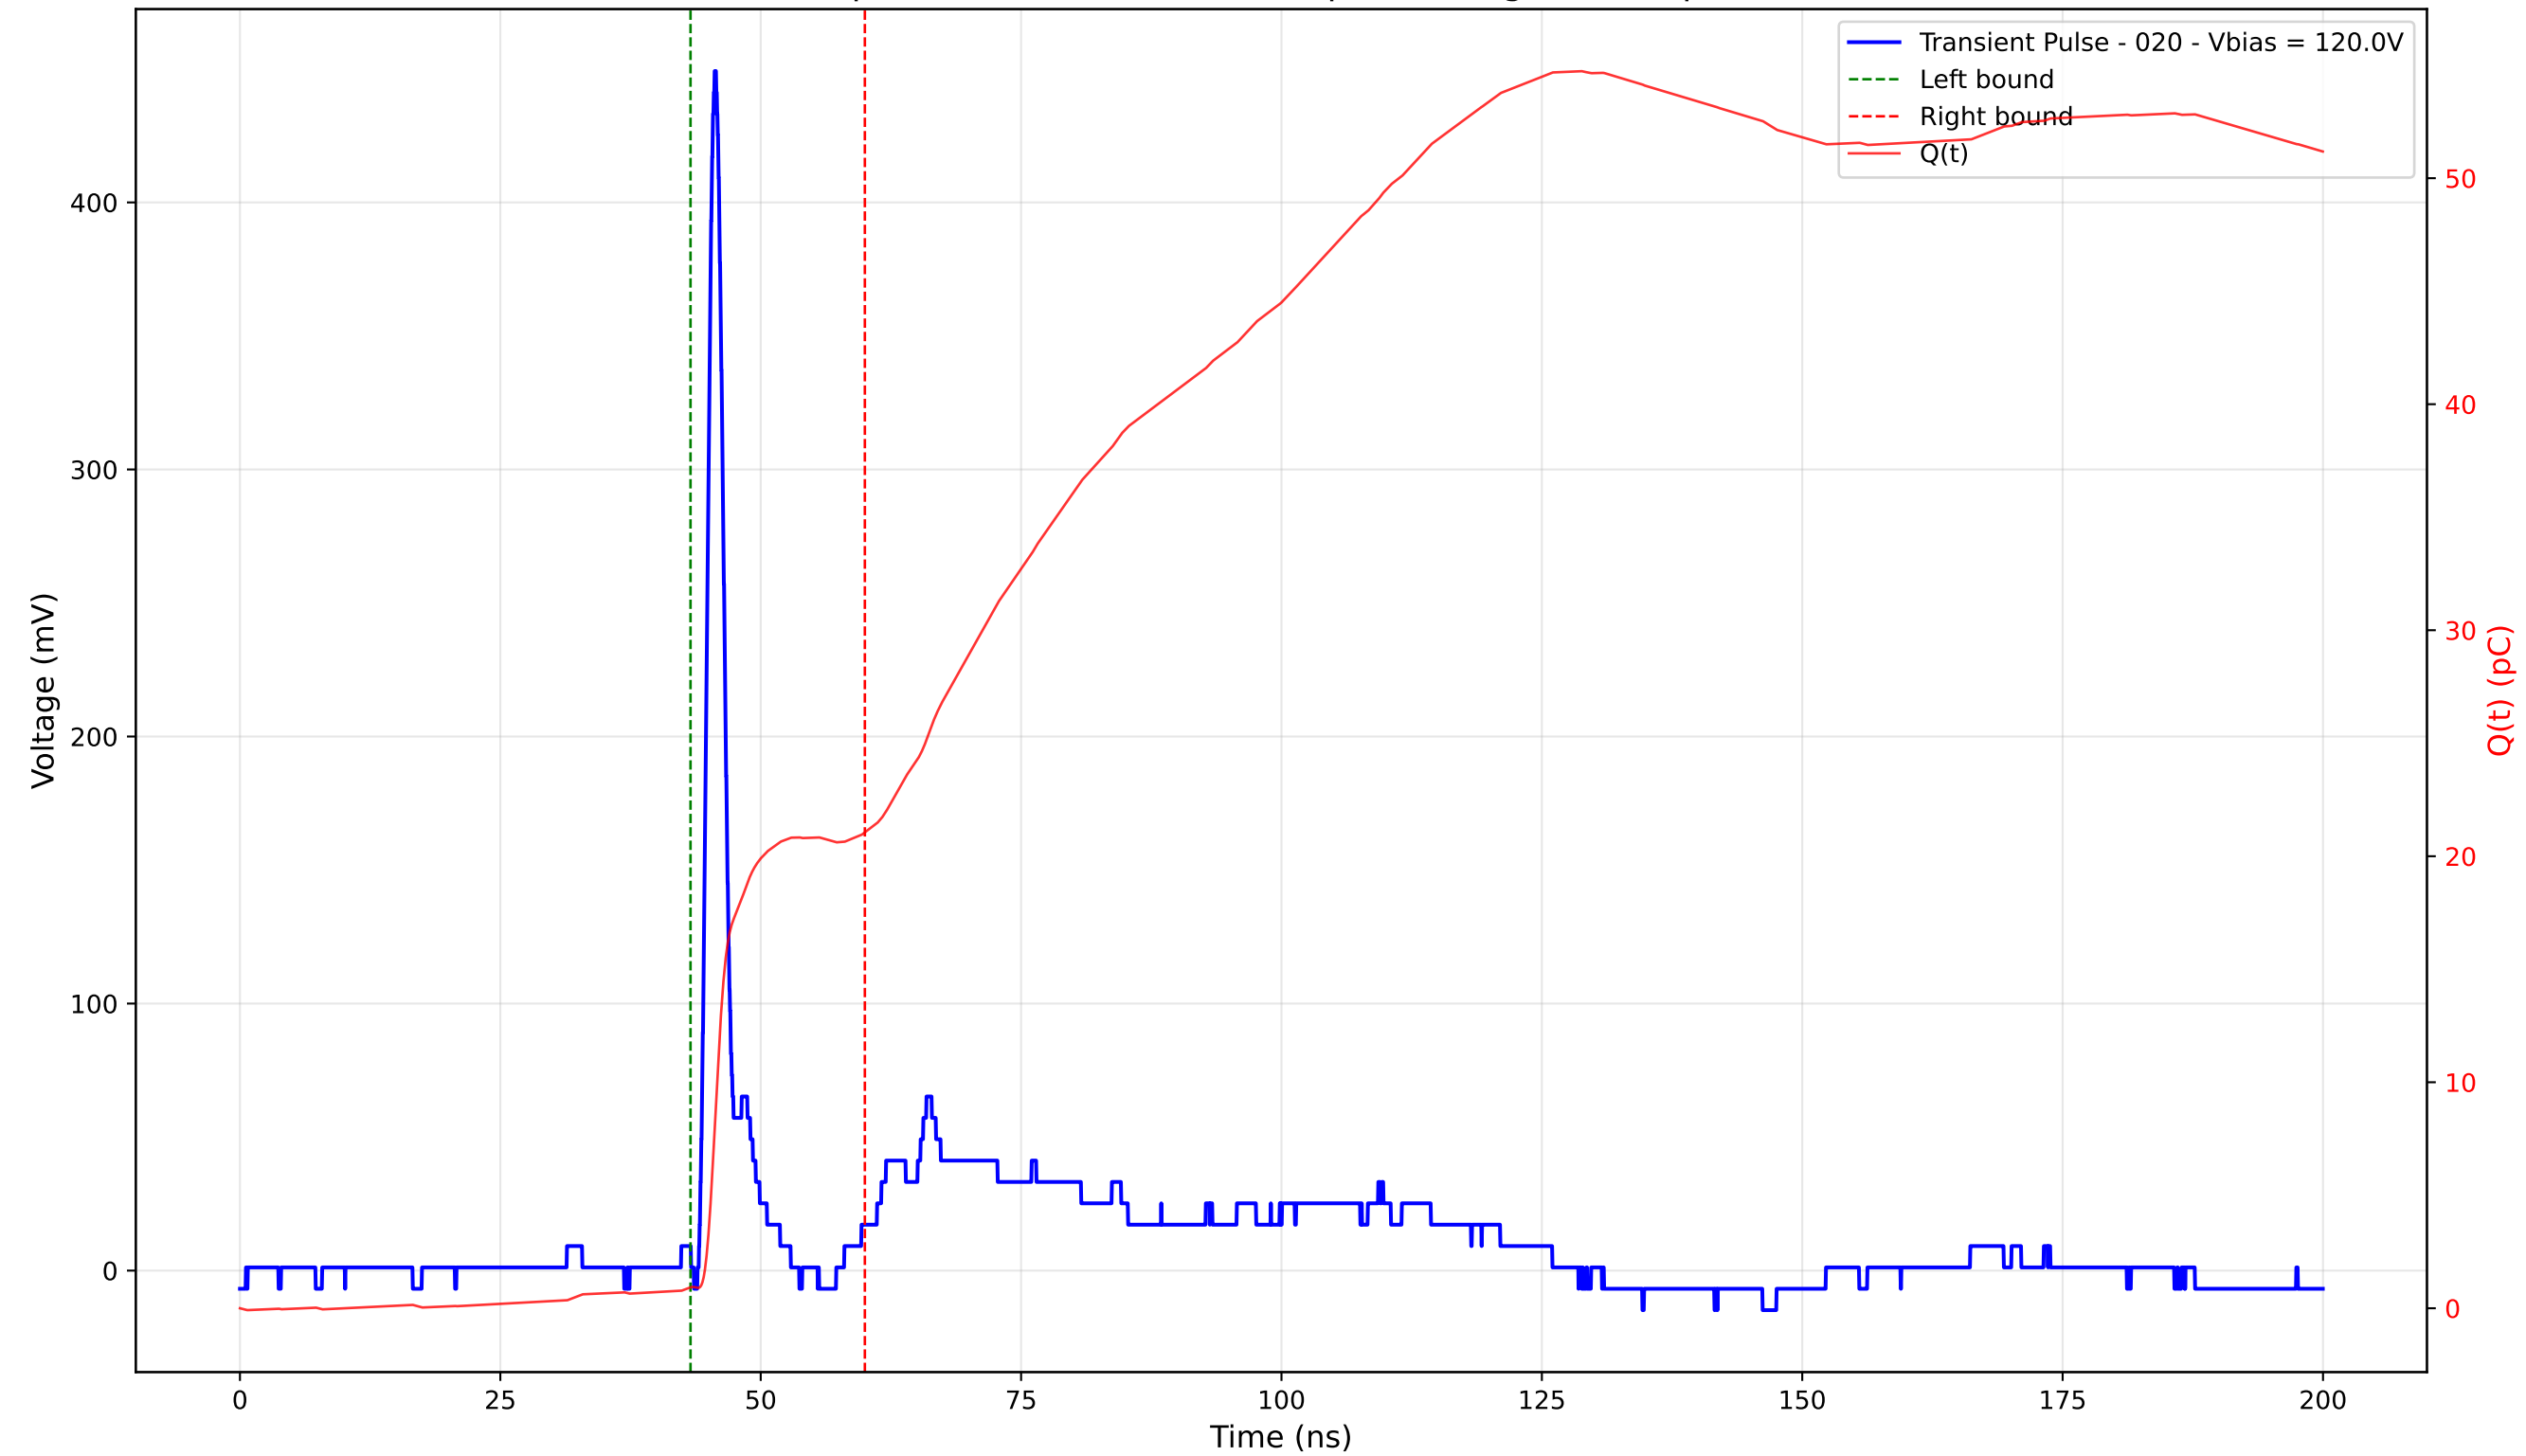


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 20.87 pC - Rise Time: 1.02 ns

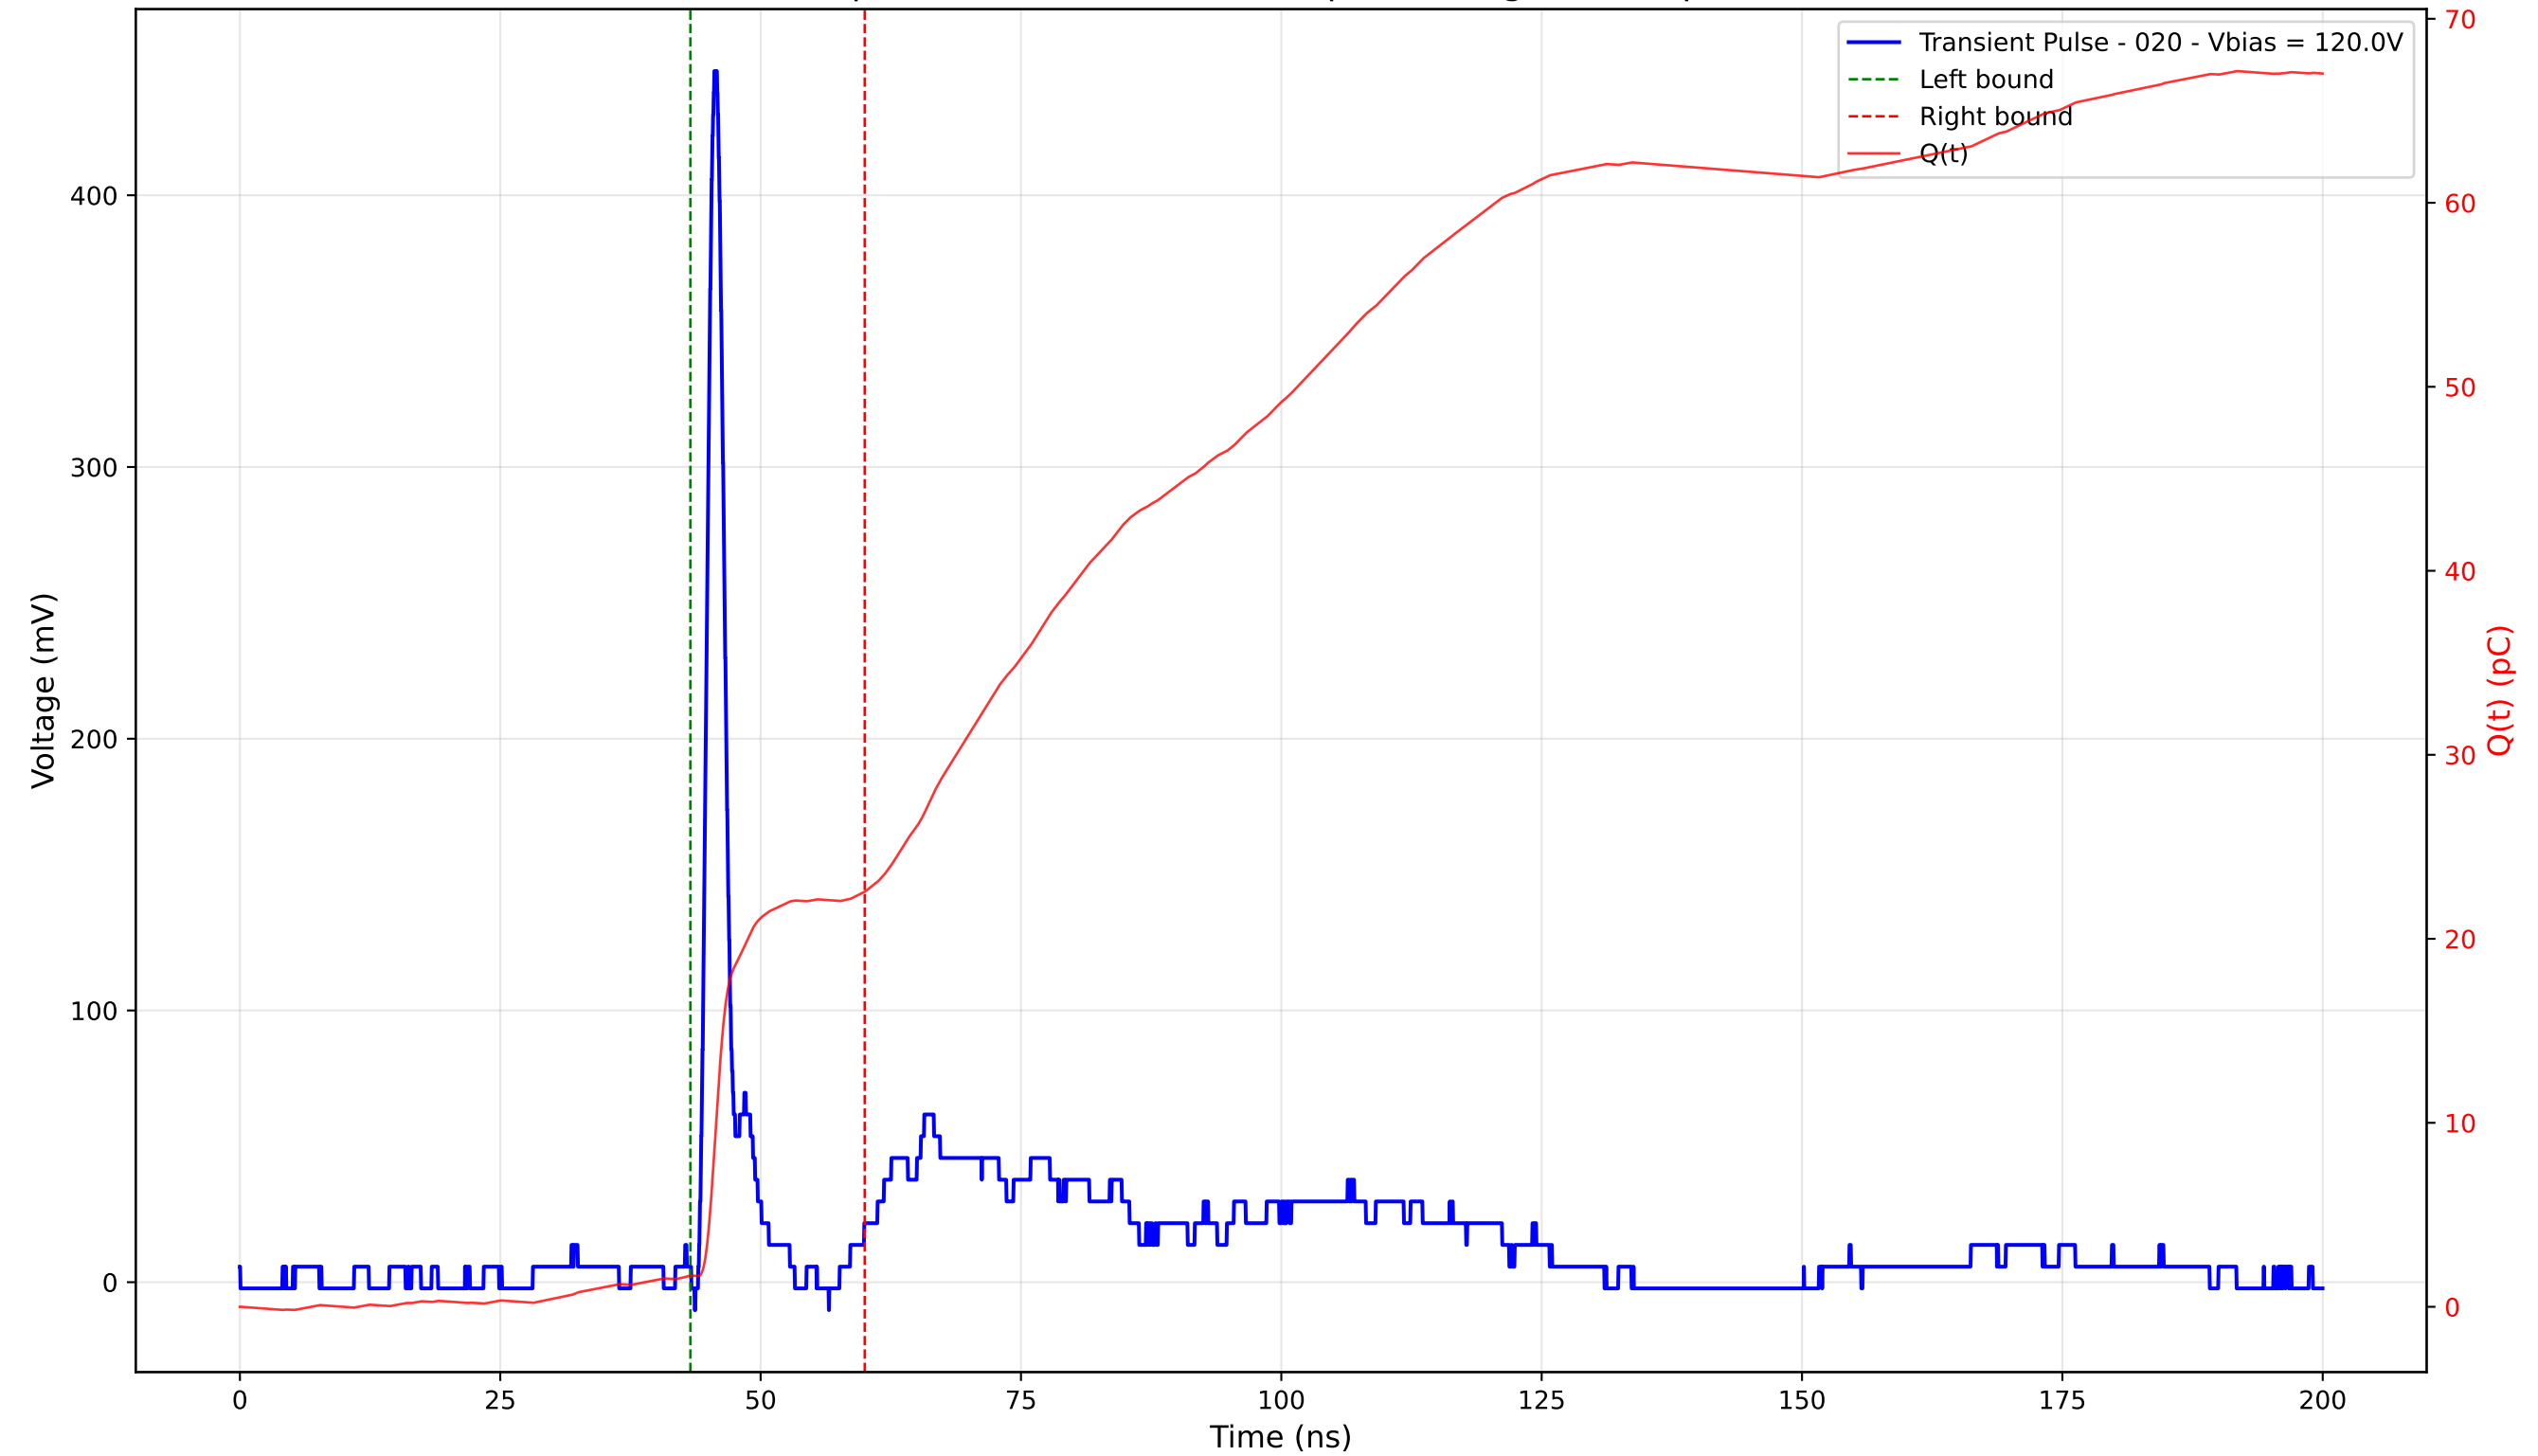


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 20.60 pC - Rise Time: 1.05 ns

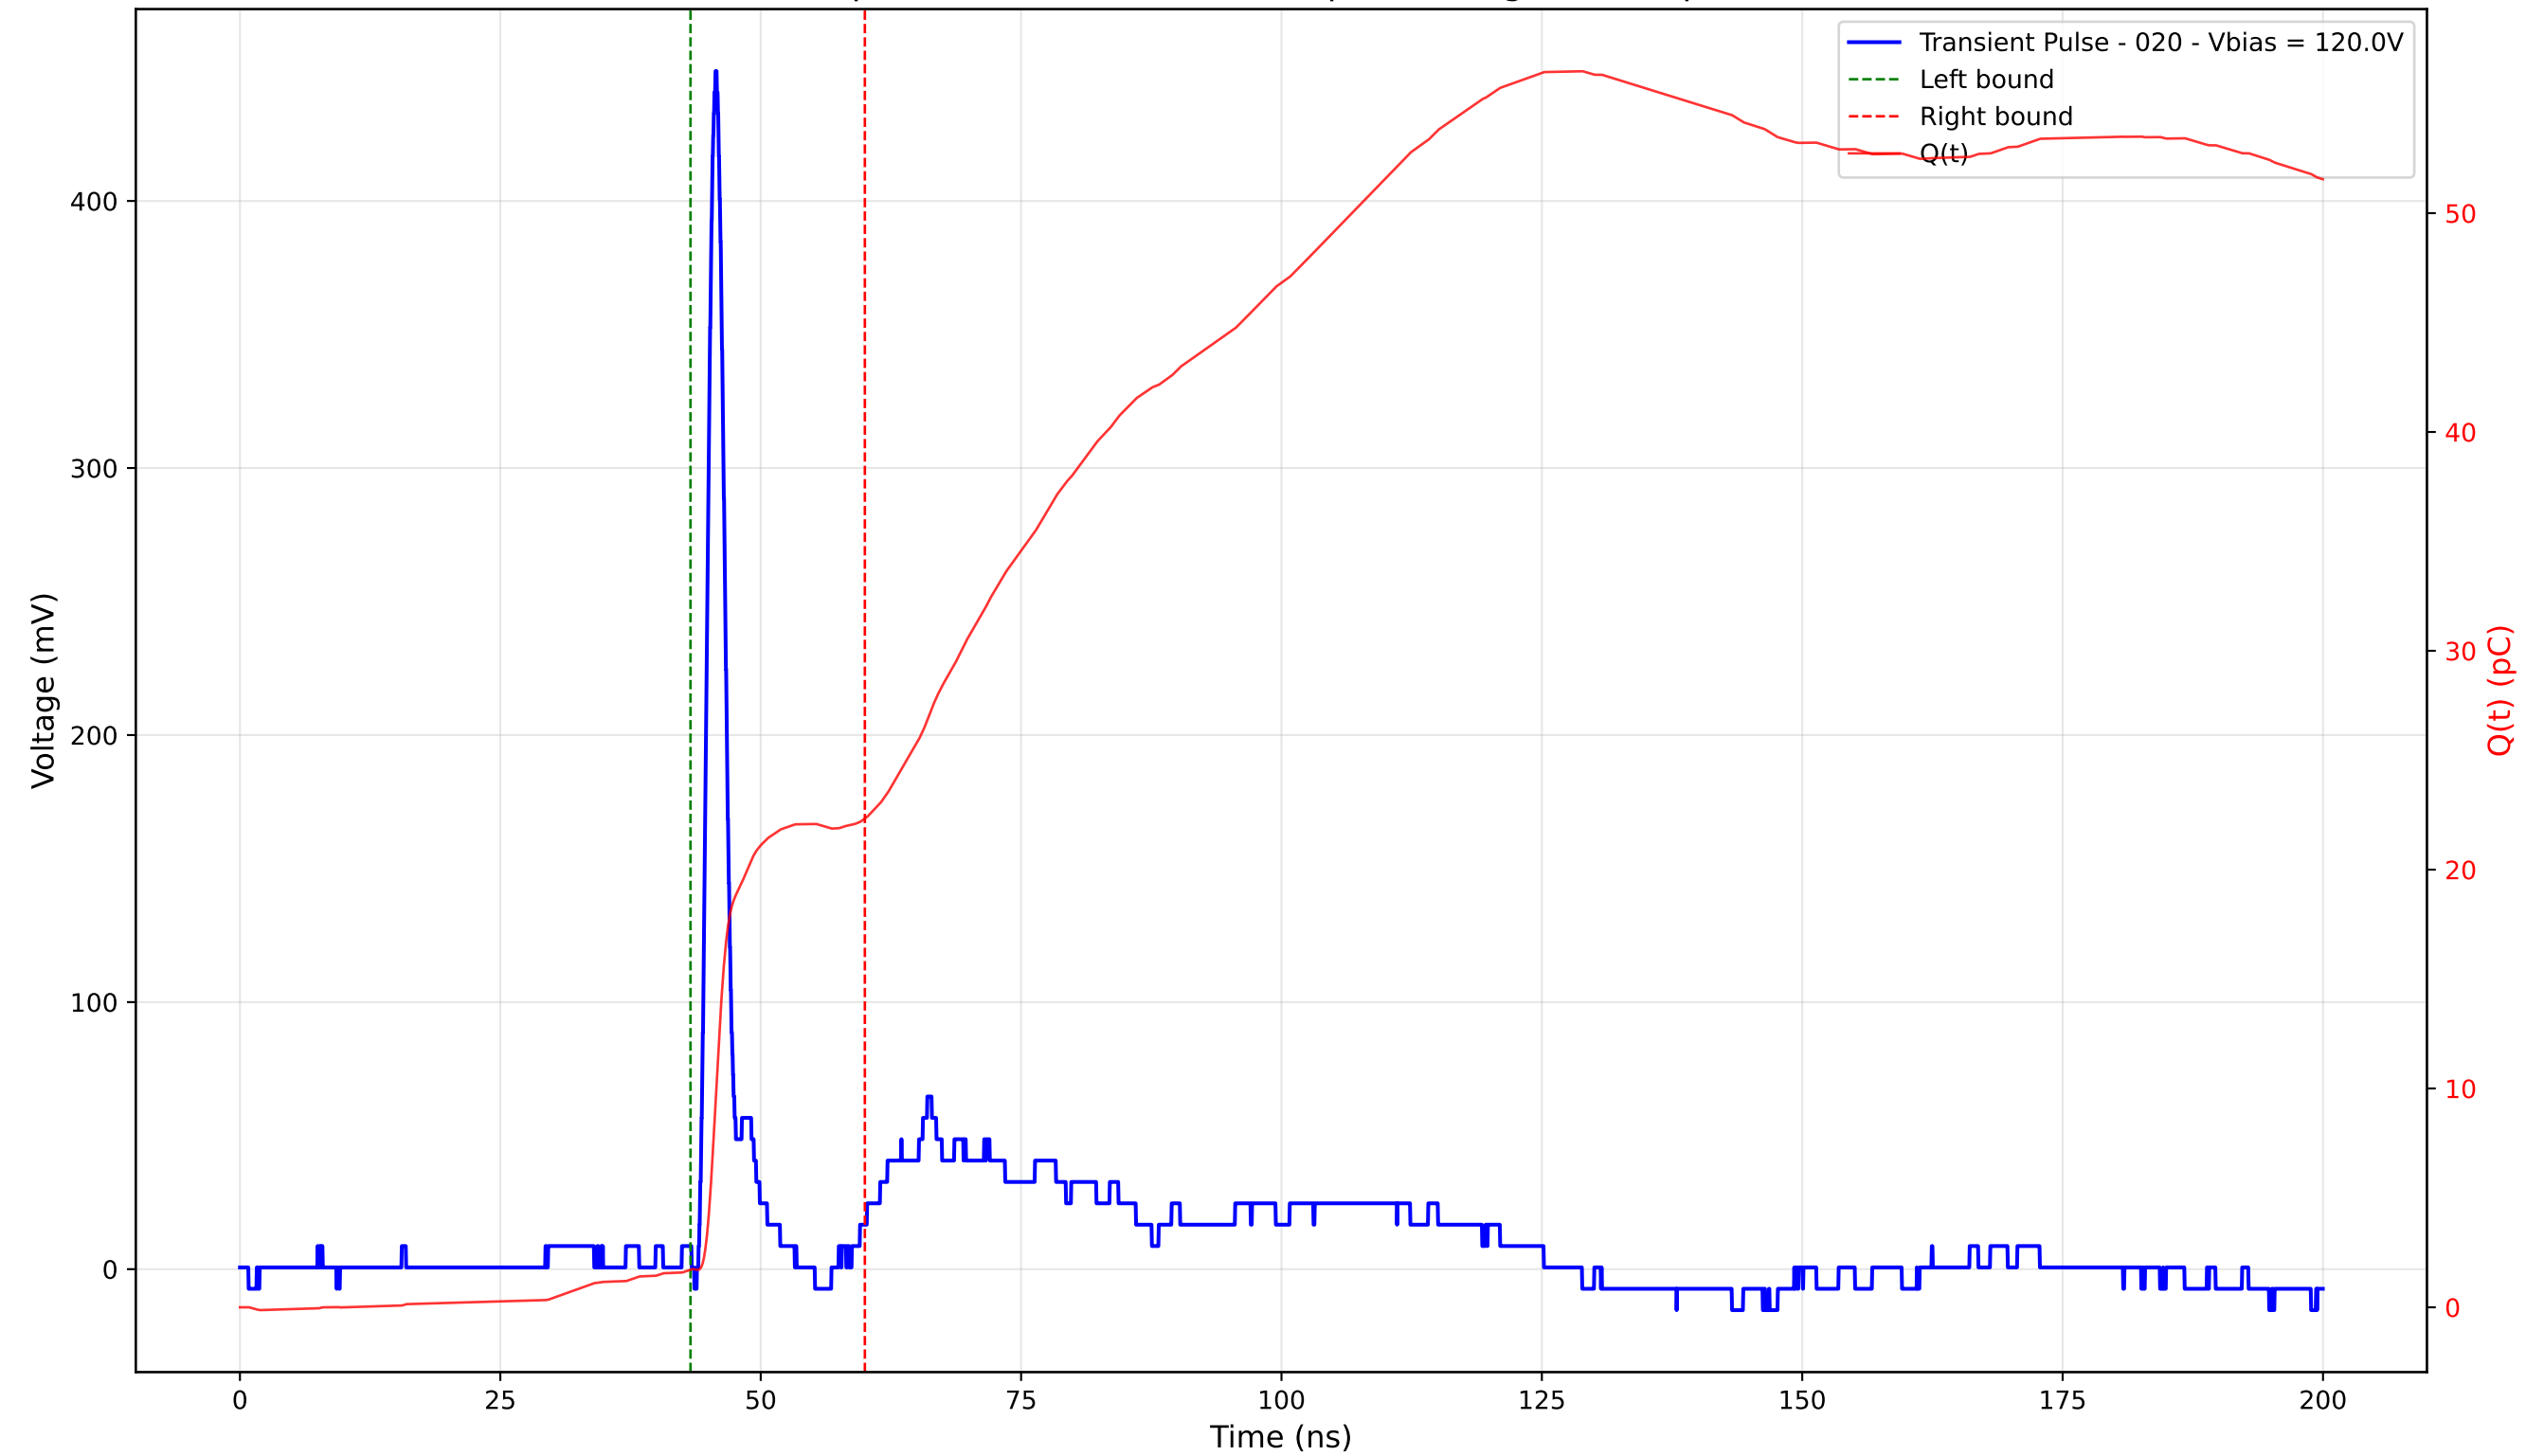


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 20.62 pC - Rise Time: 1.10 ns

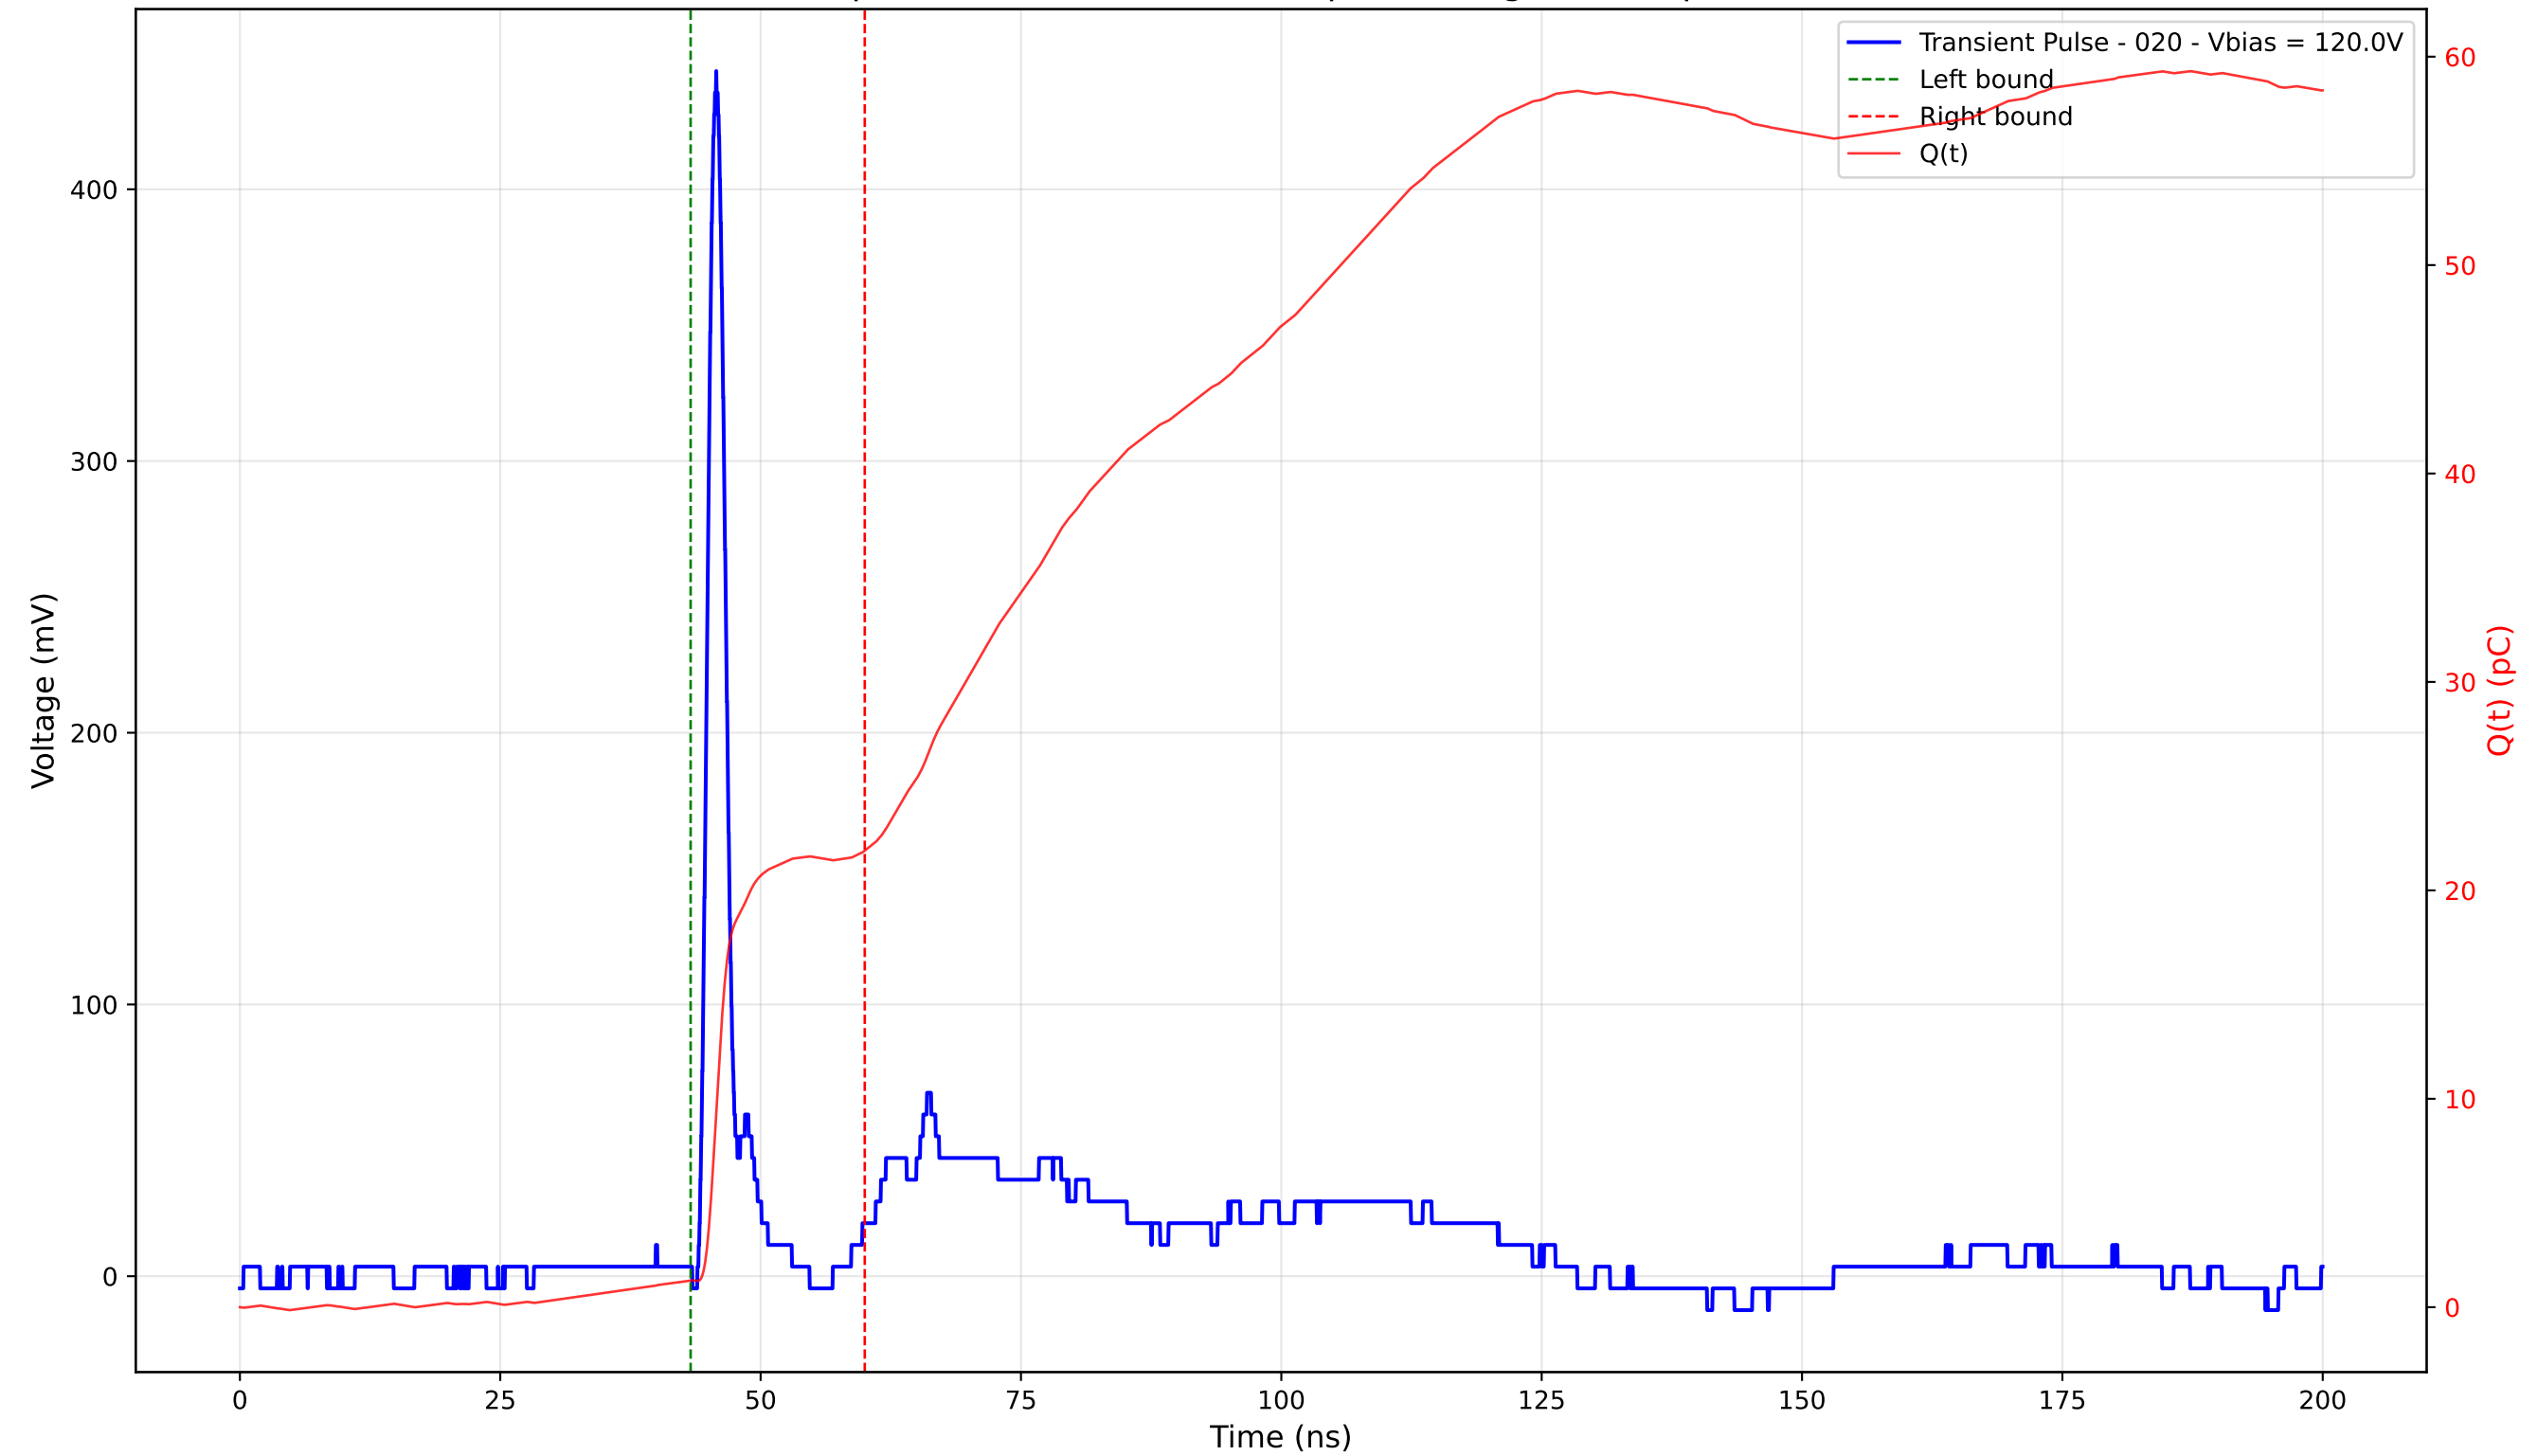


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 20.33 pC - Rise Time: 1.09 ns

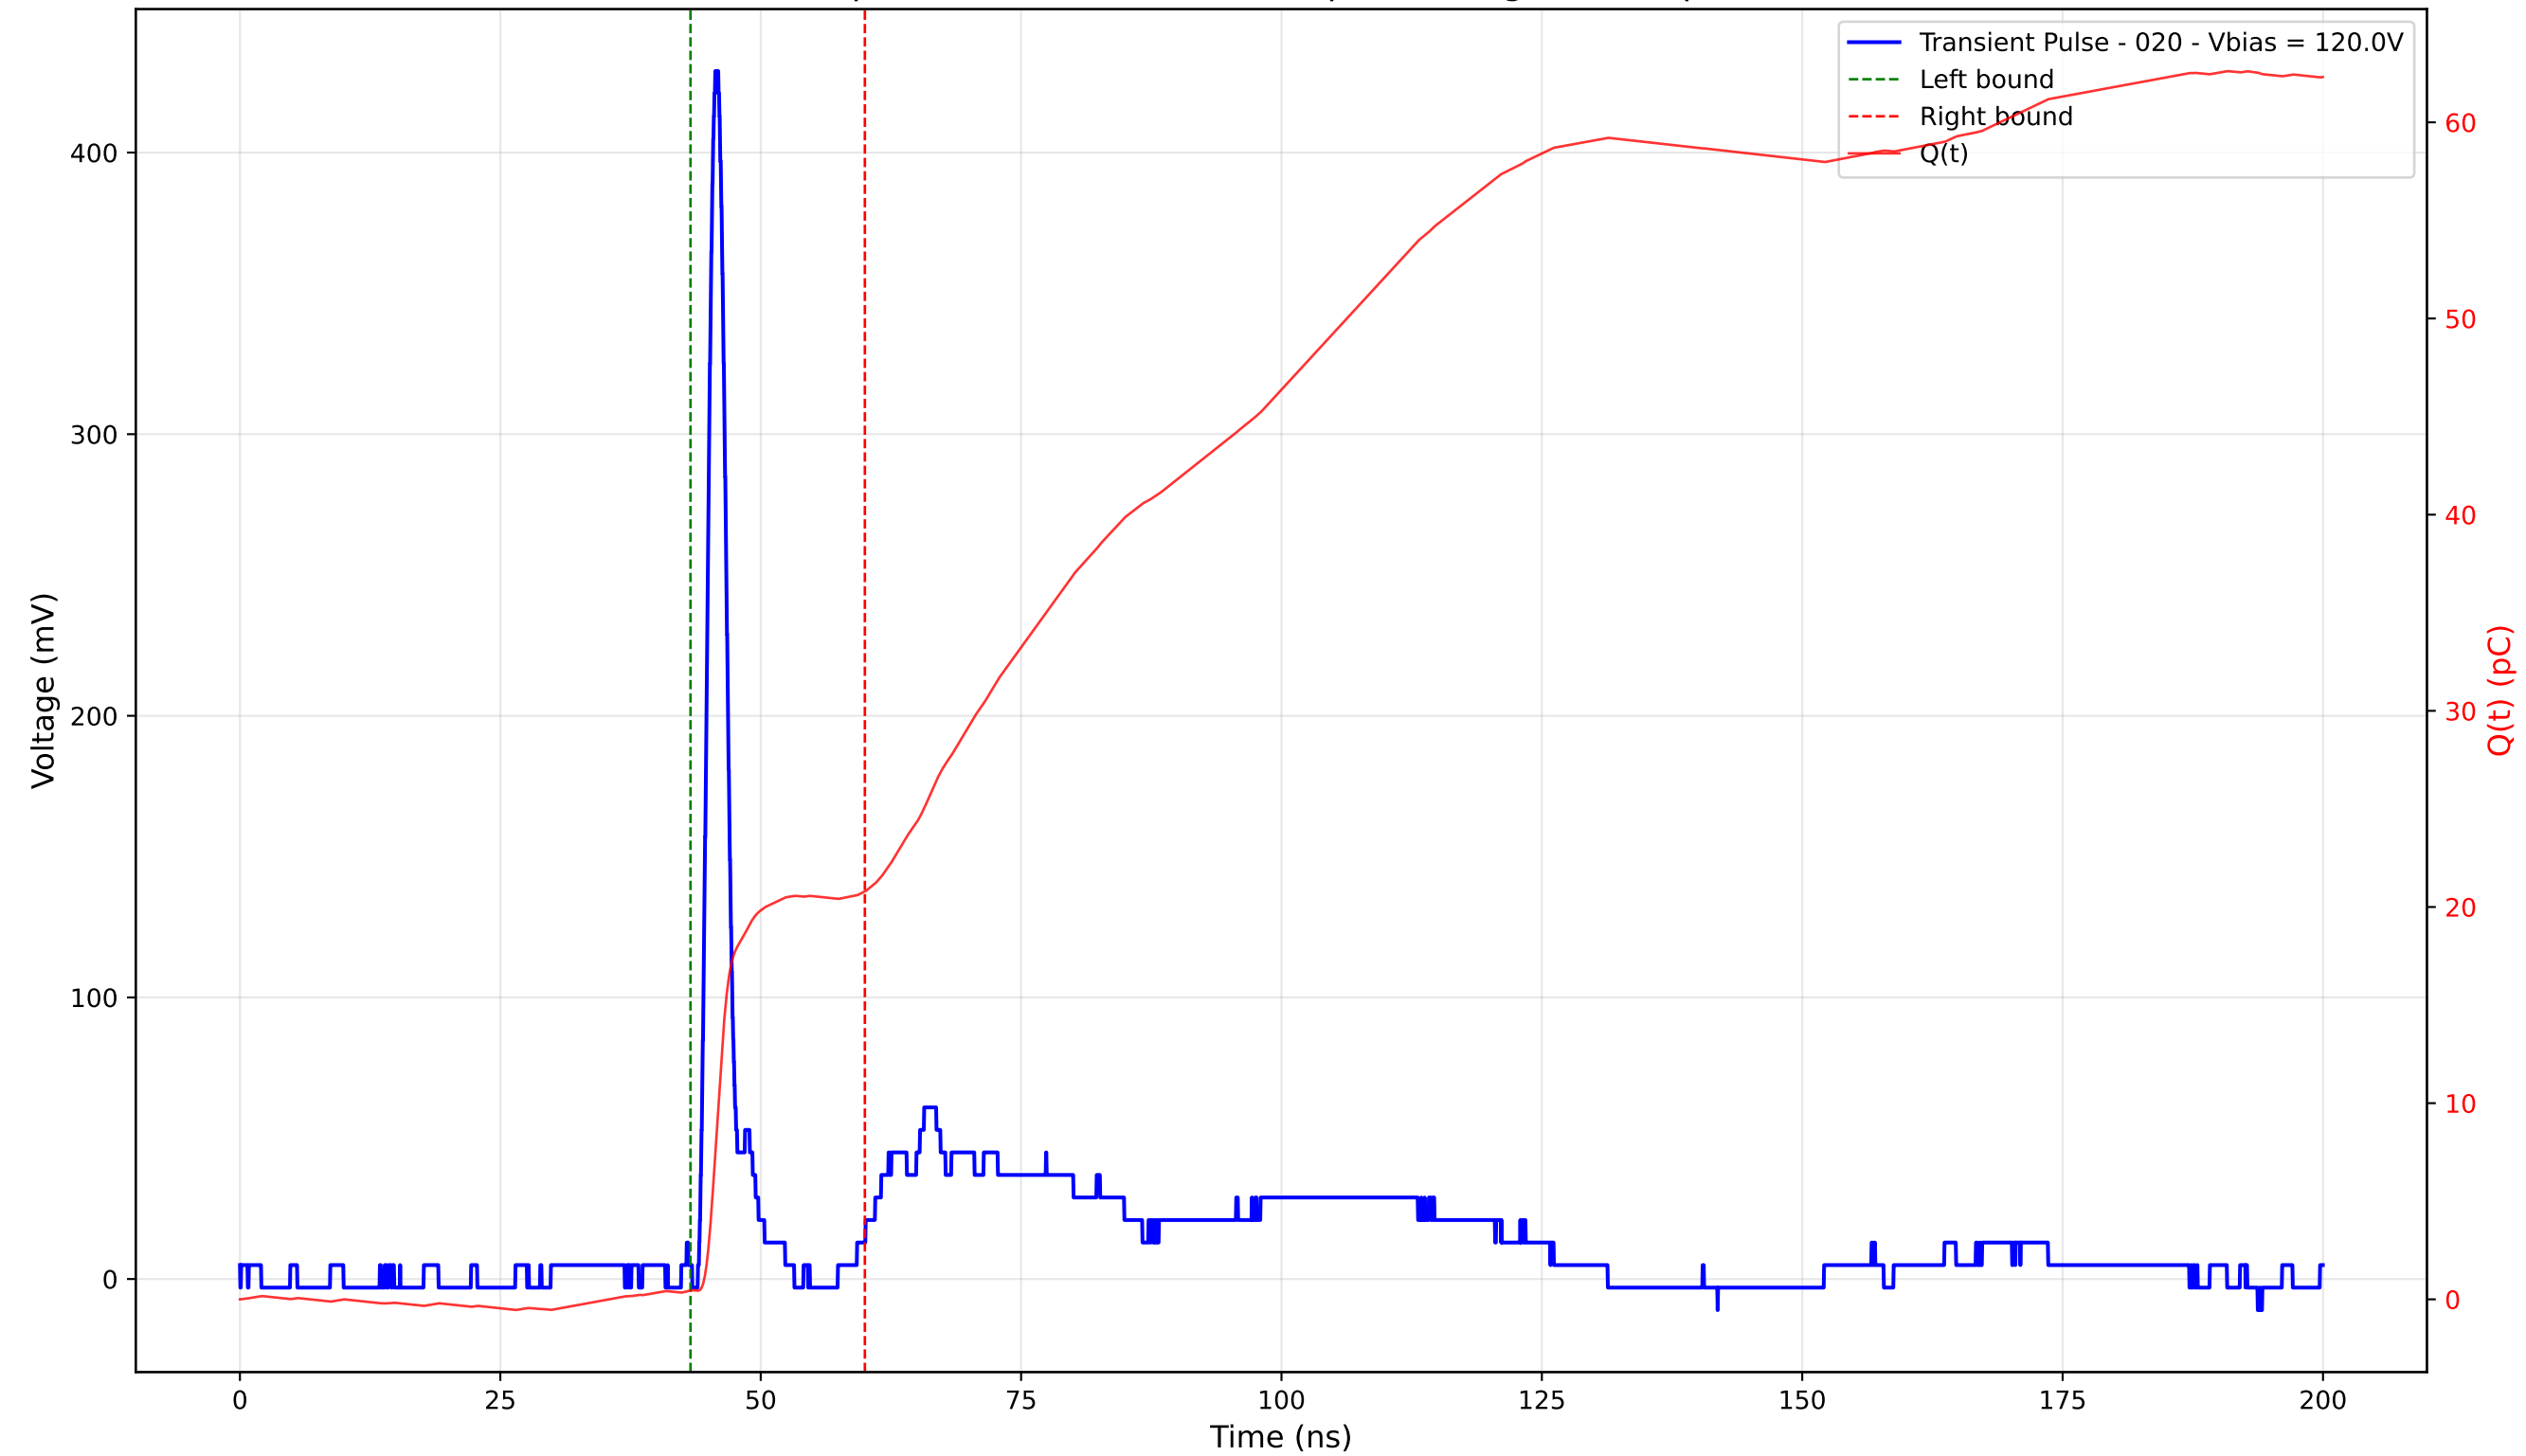


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 20.77 pC - Rise Time: 1.14 ns

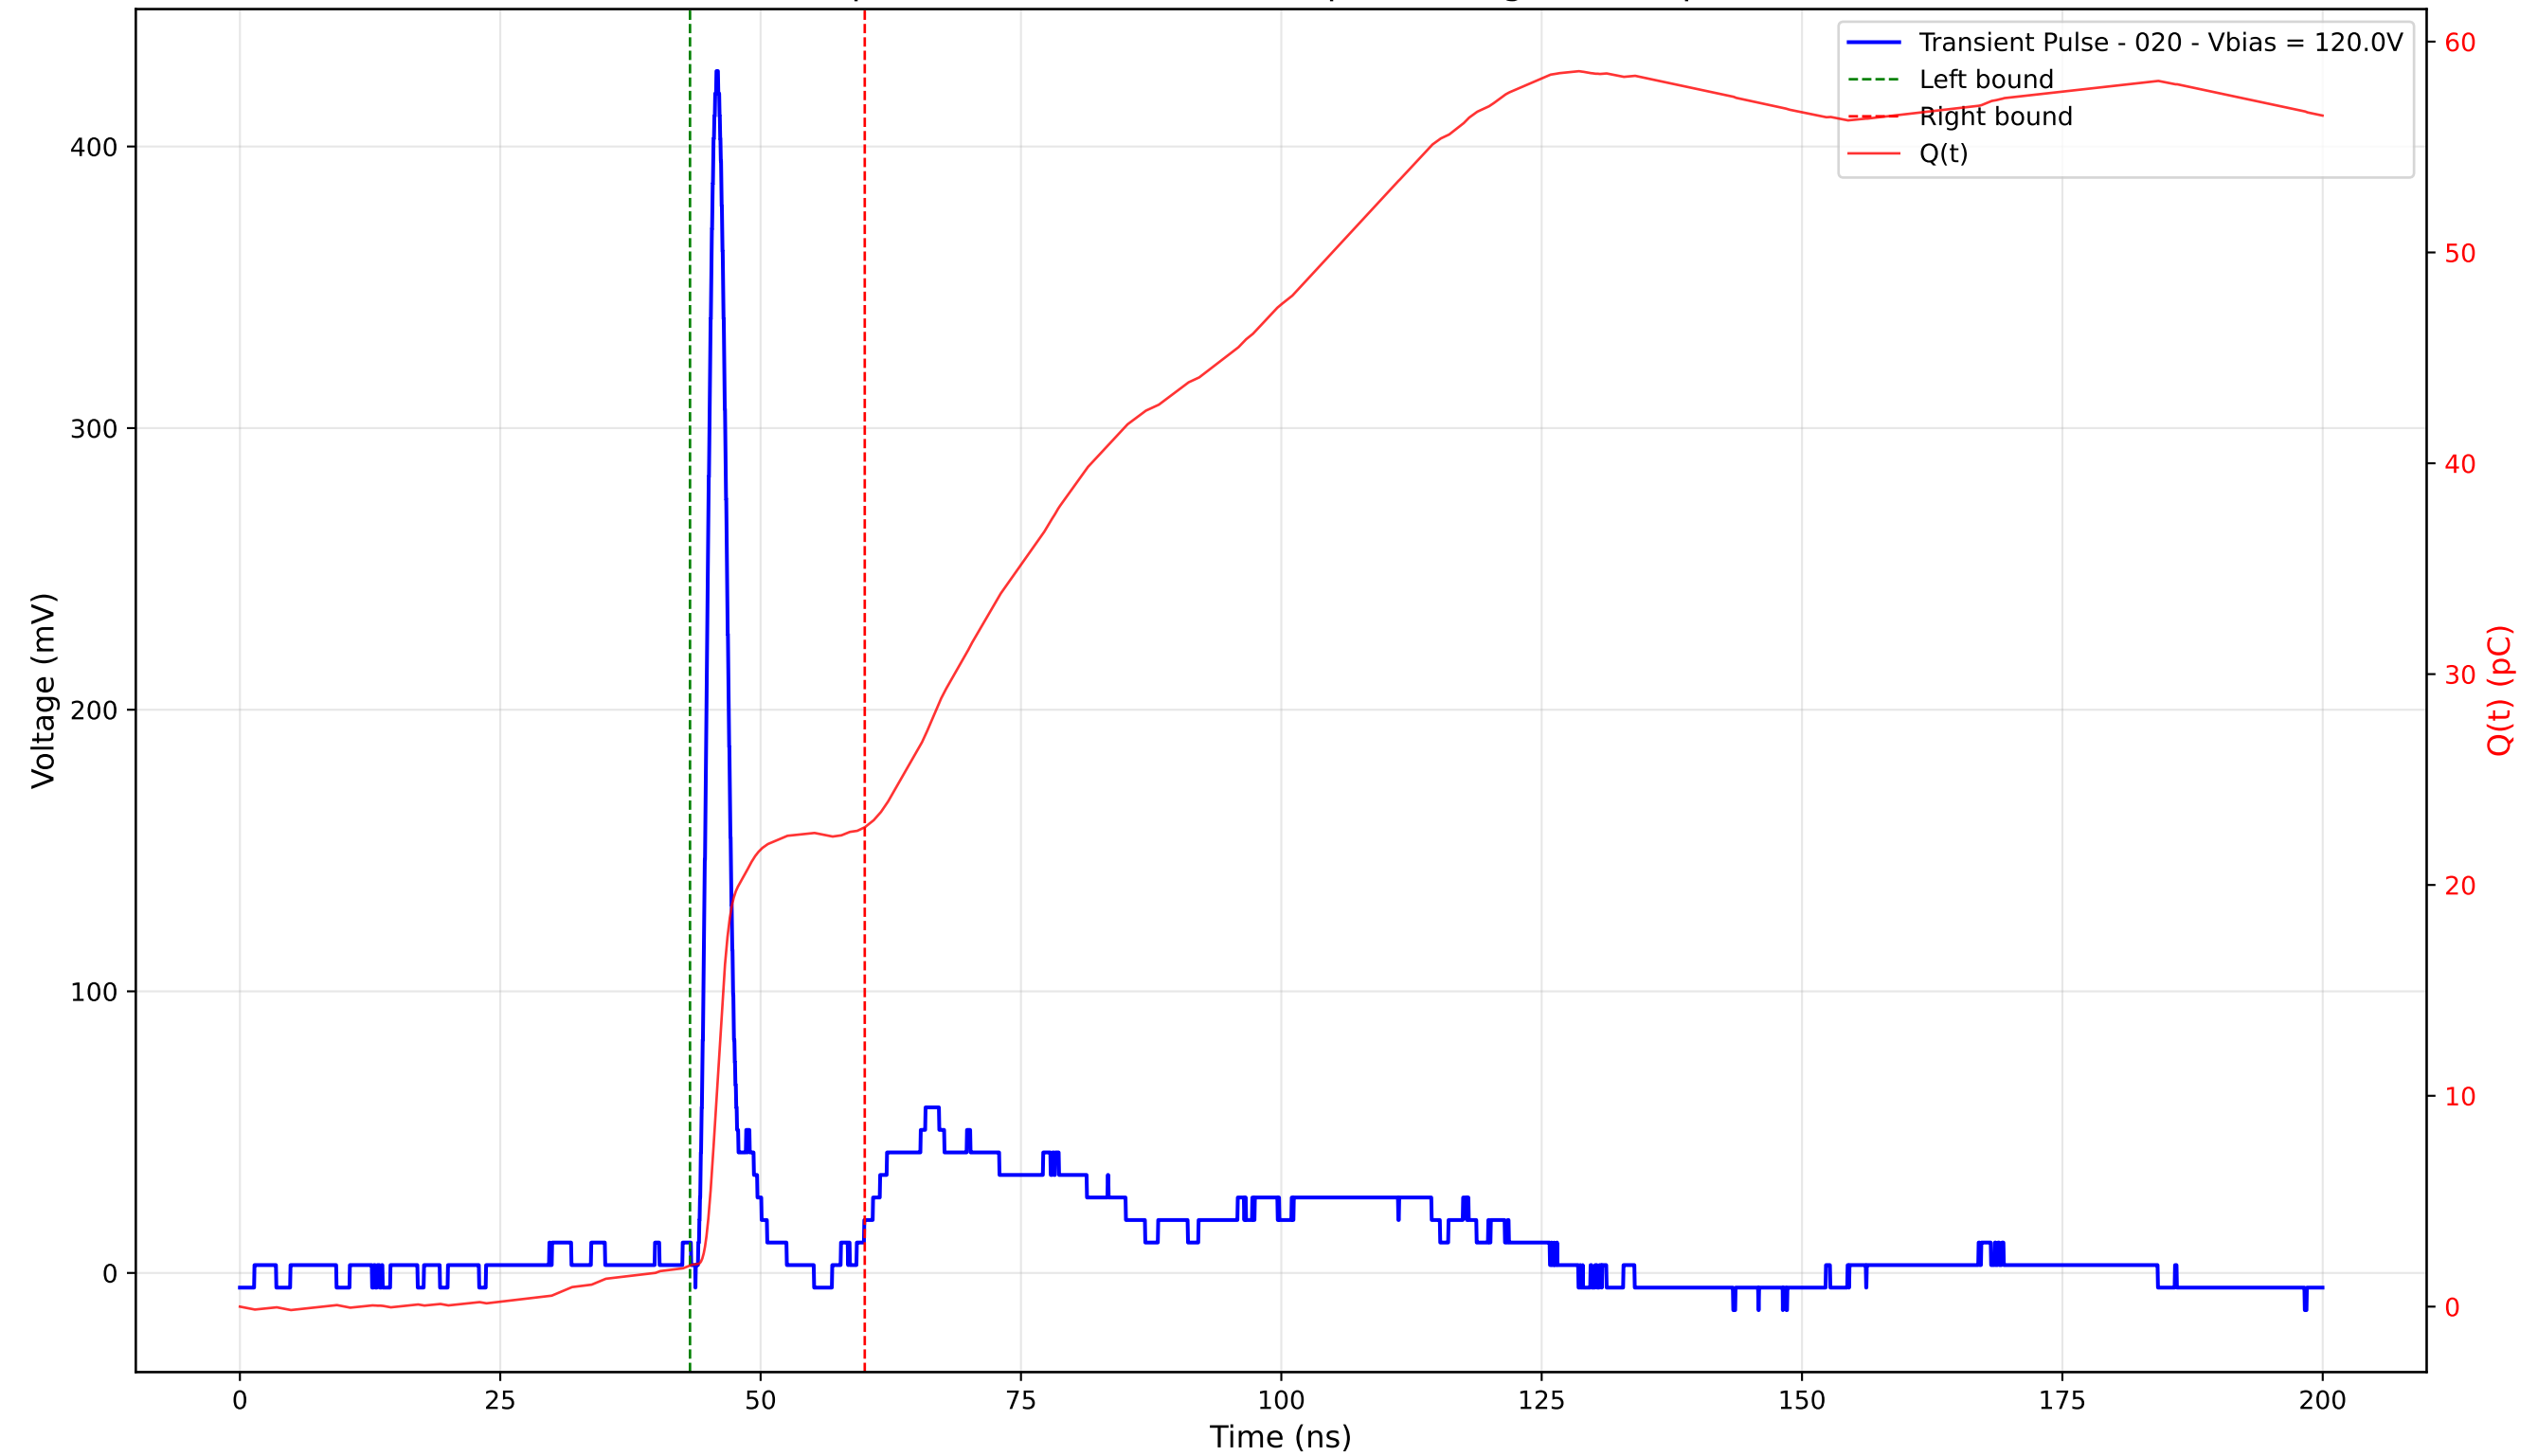


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 19.91 pC - Rise Time: 1.08 ns

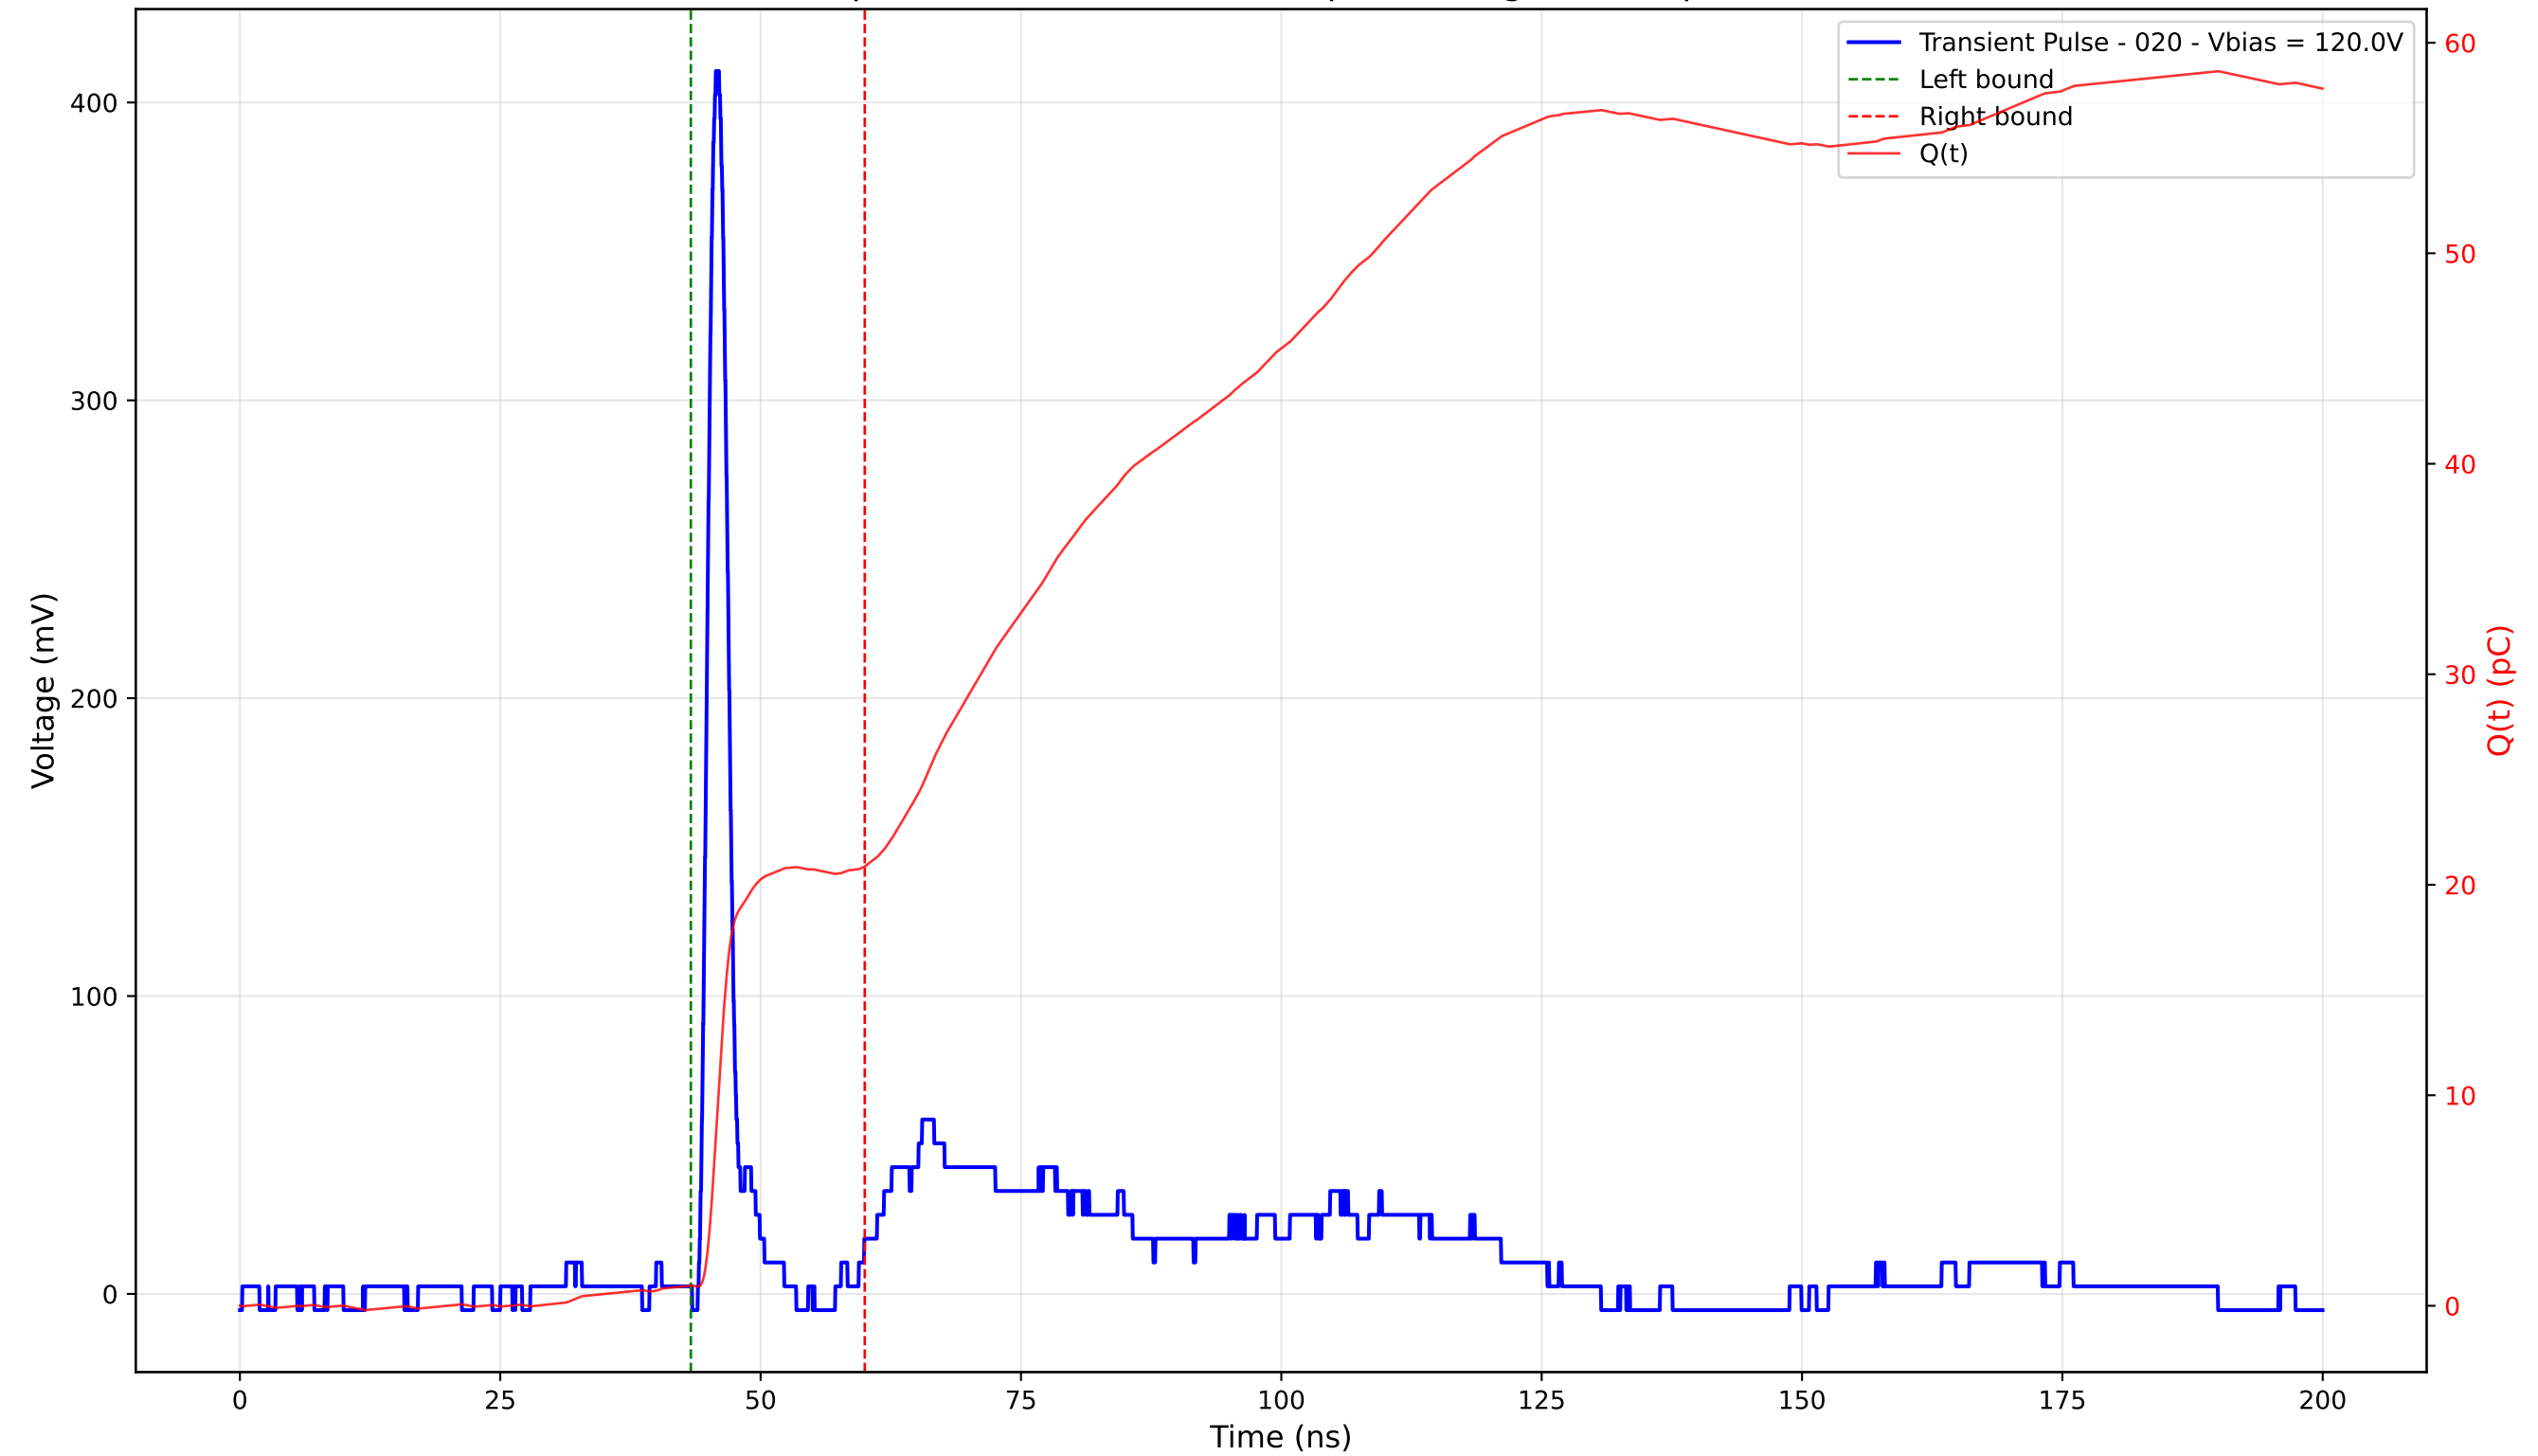


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 19.17 pC - Rise Time: 1.15 ns

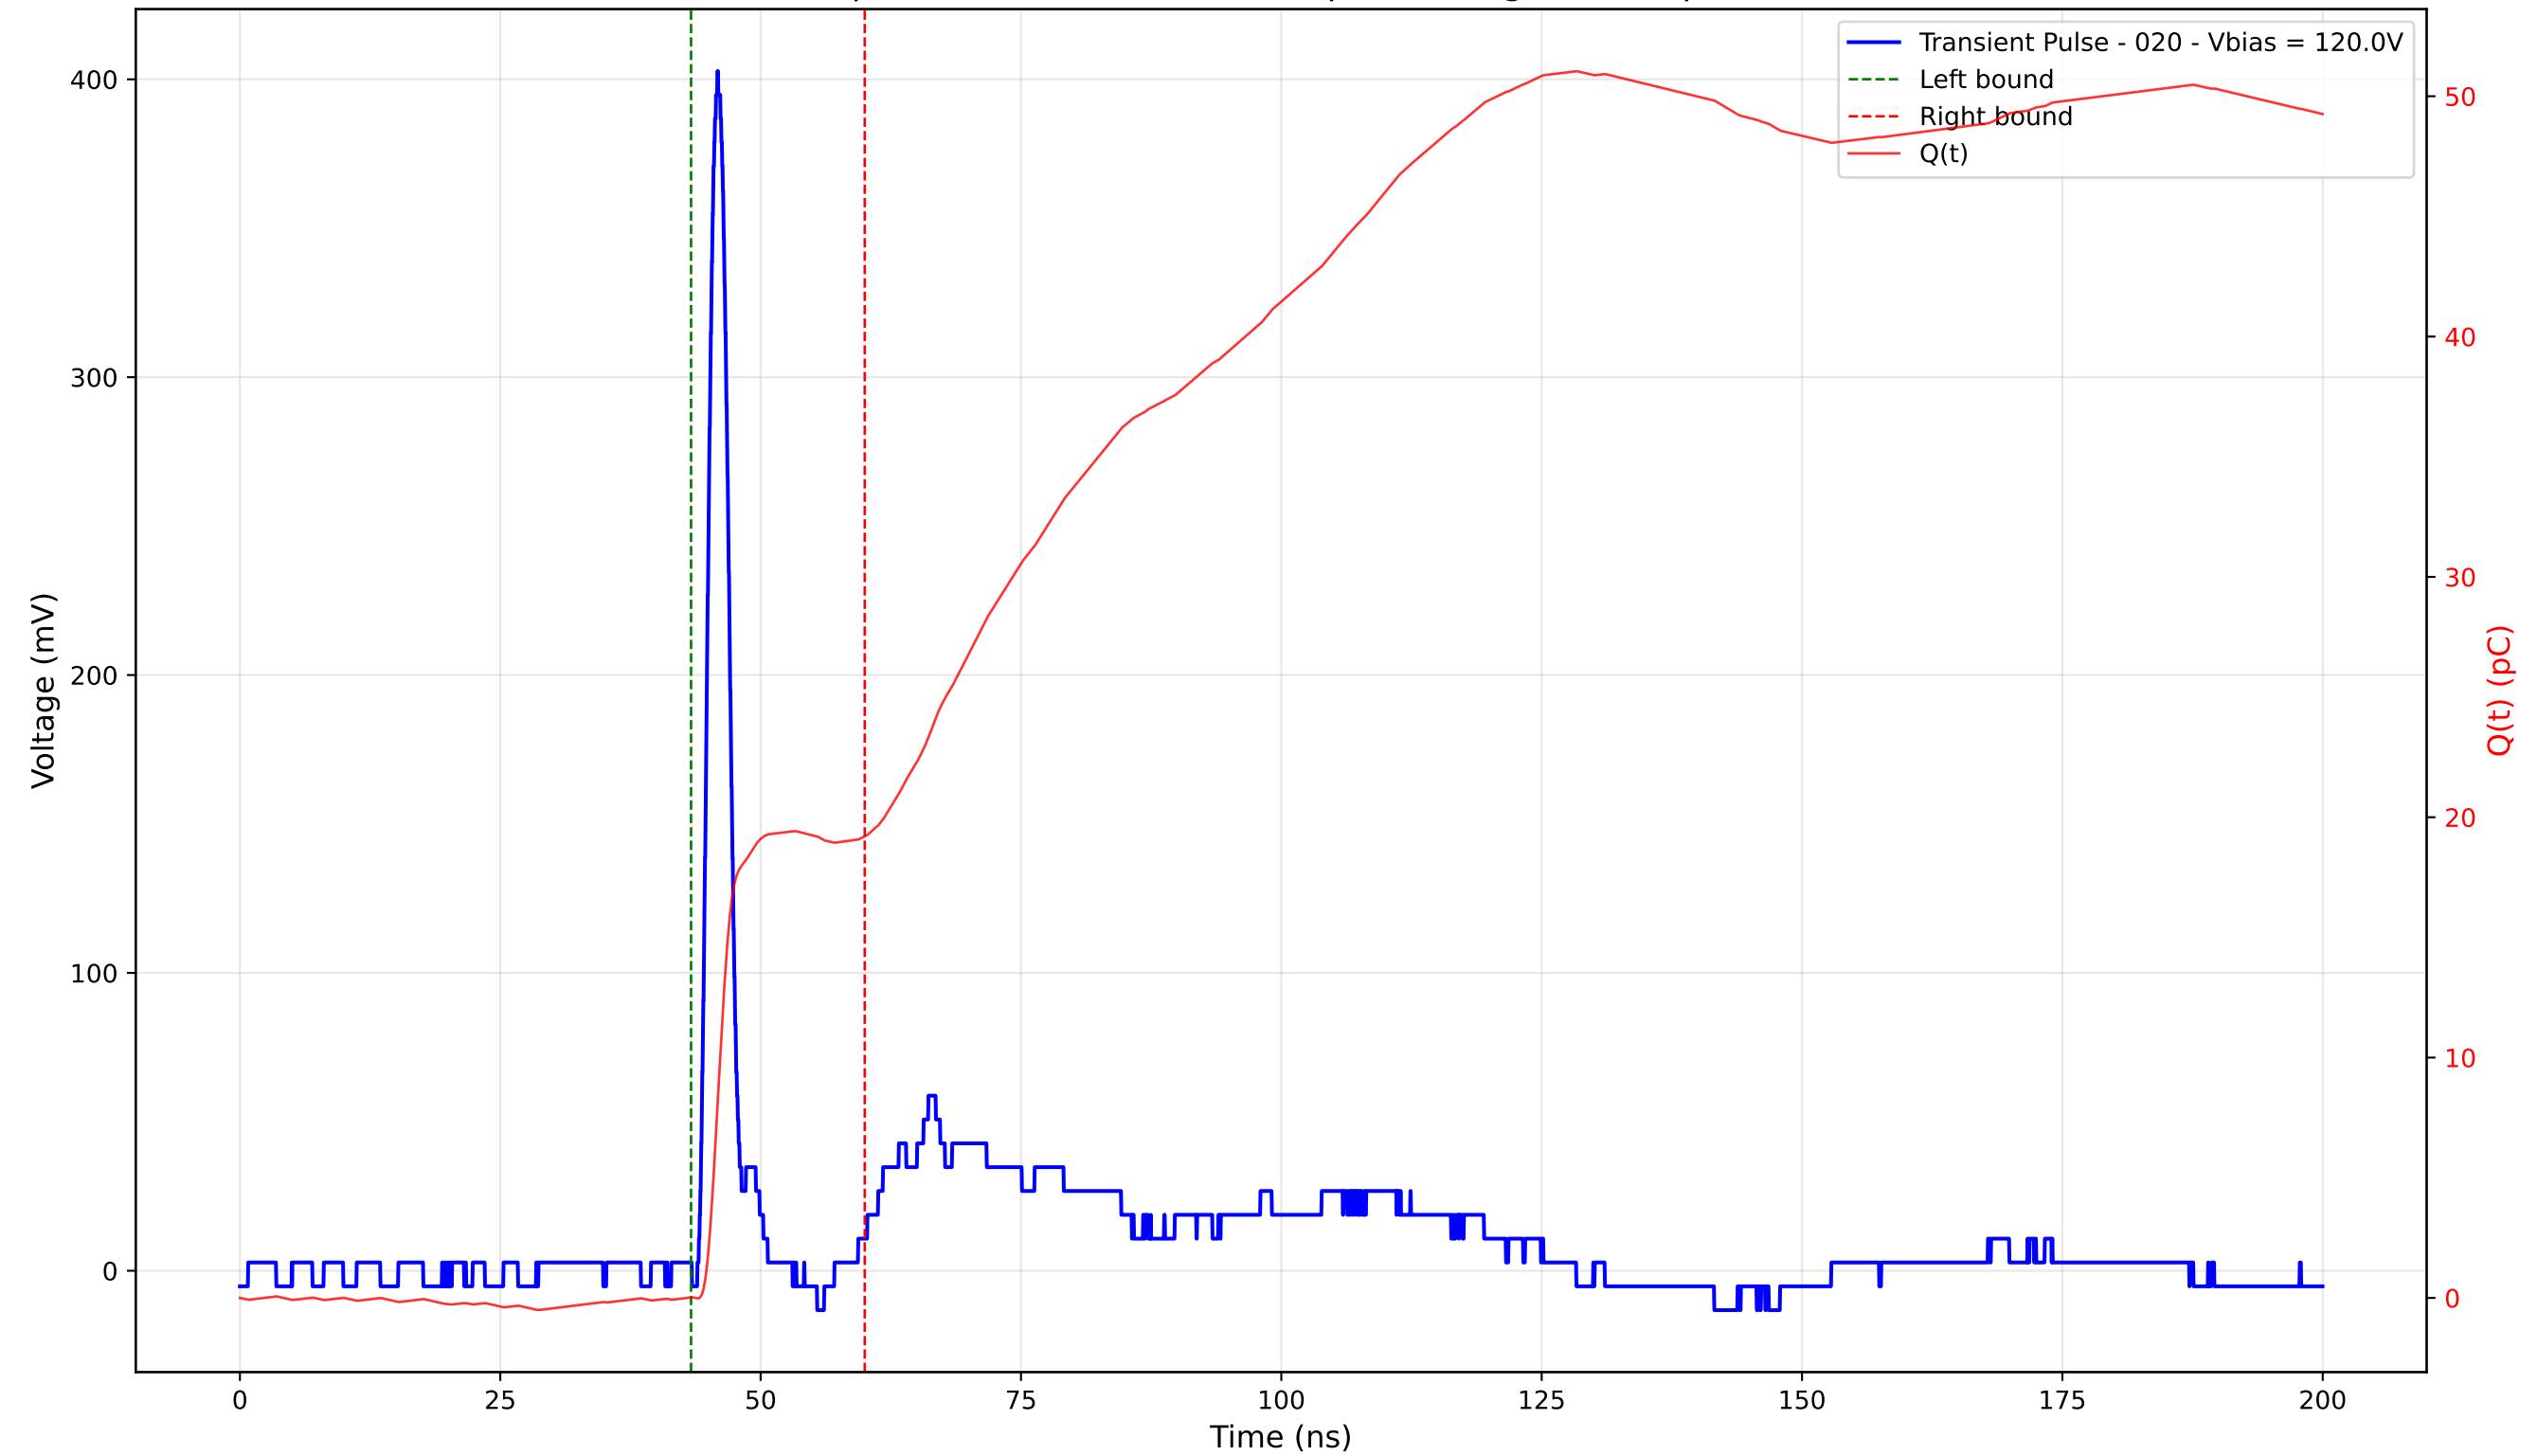


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 19.25 pC - Rise Time: 1.19 ns

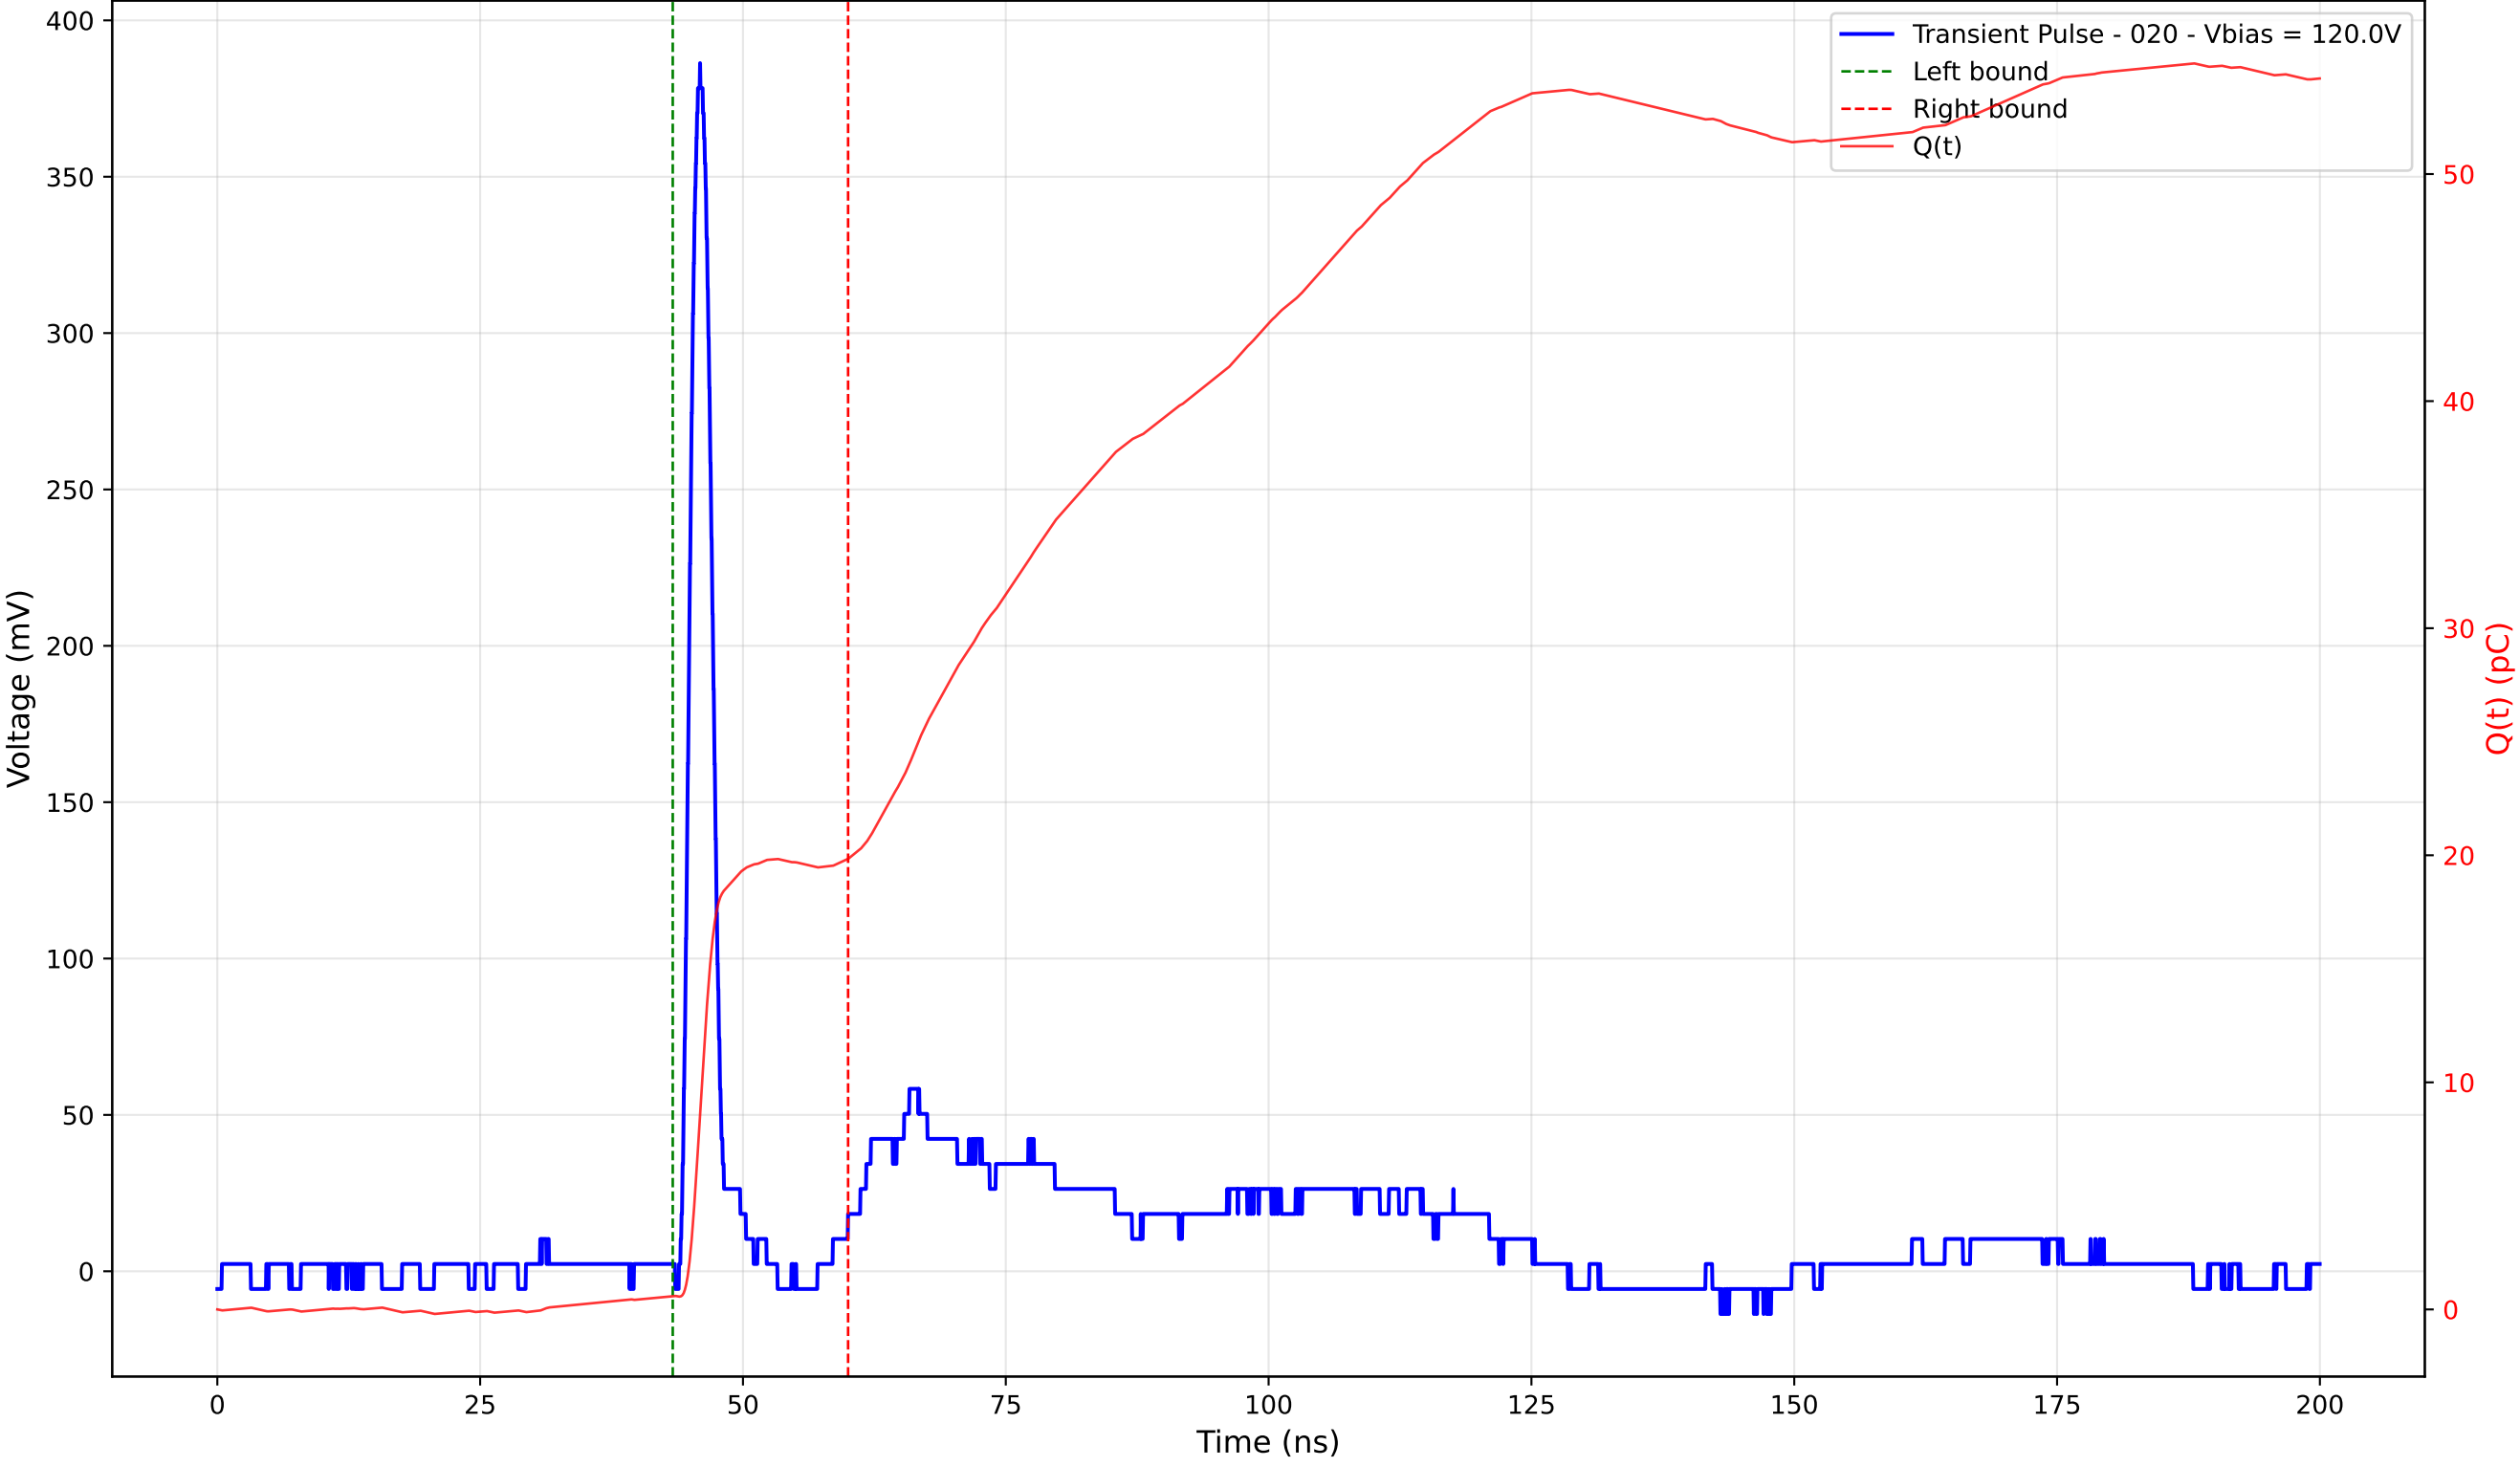


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 19.27 pC - Rise Time: 1.19 ns

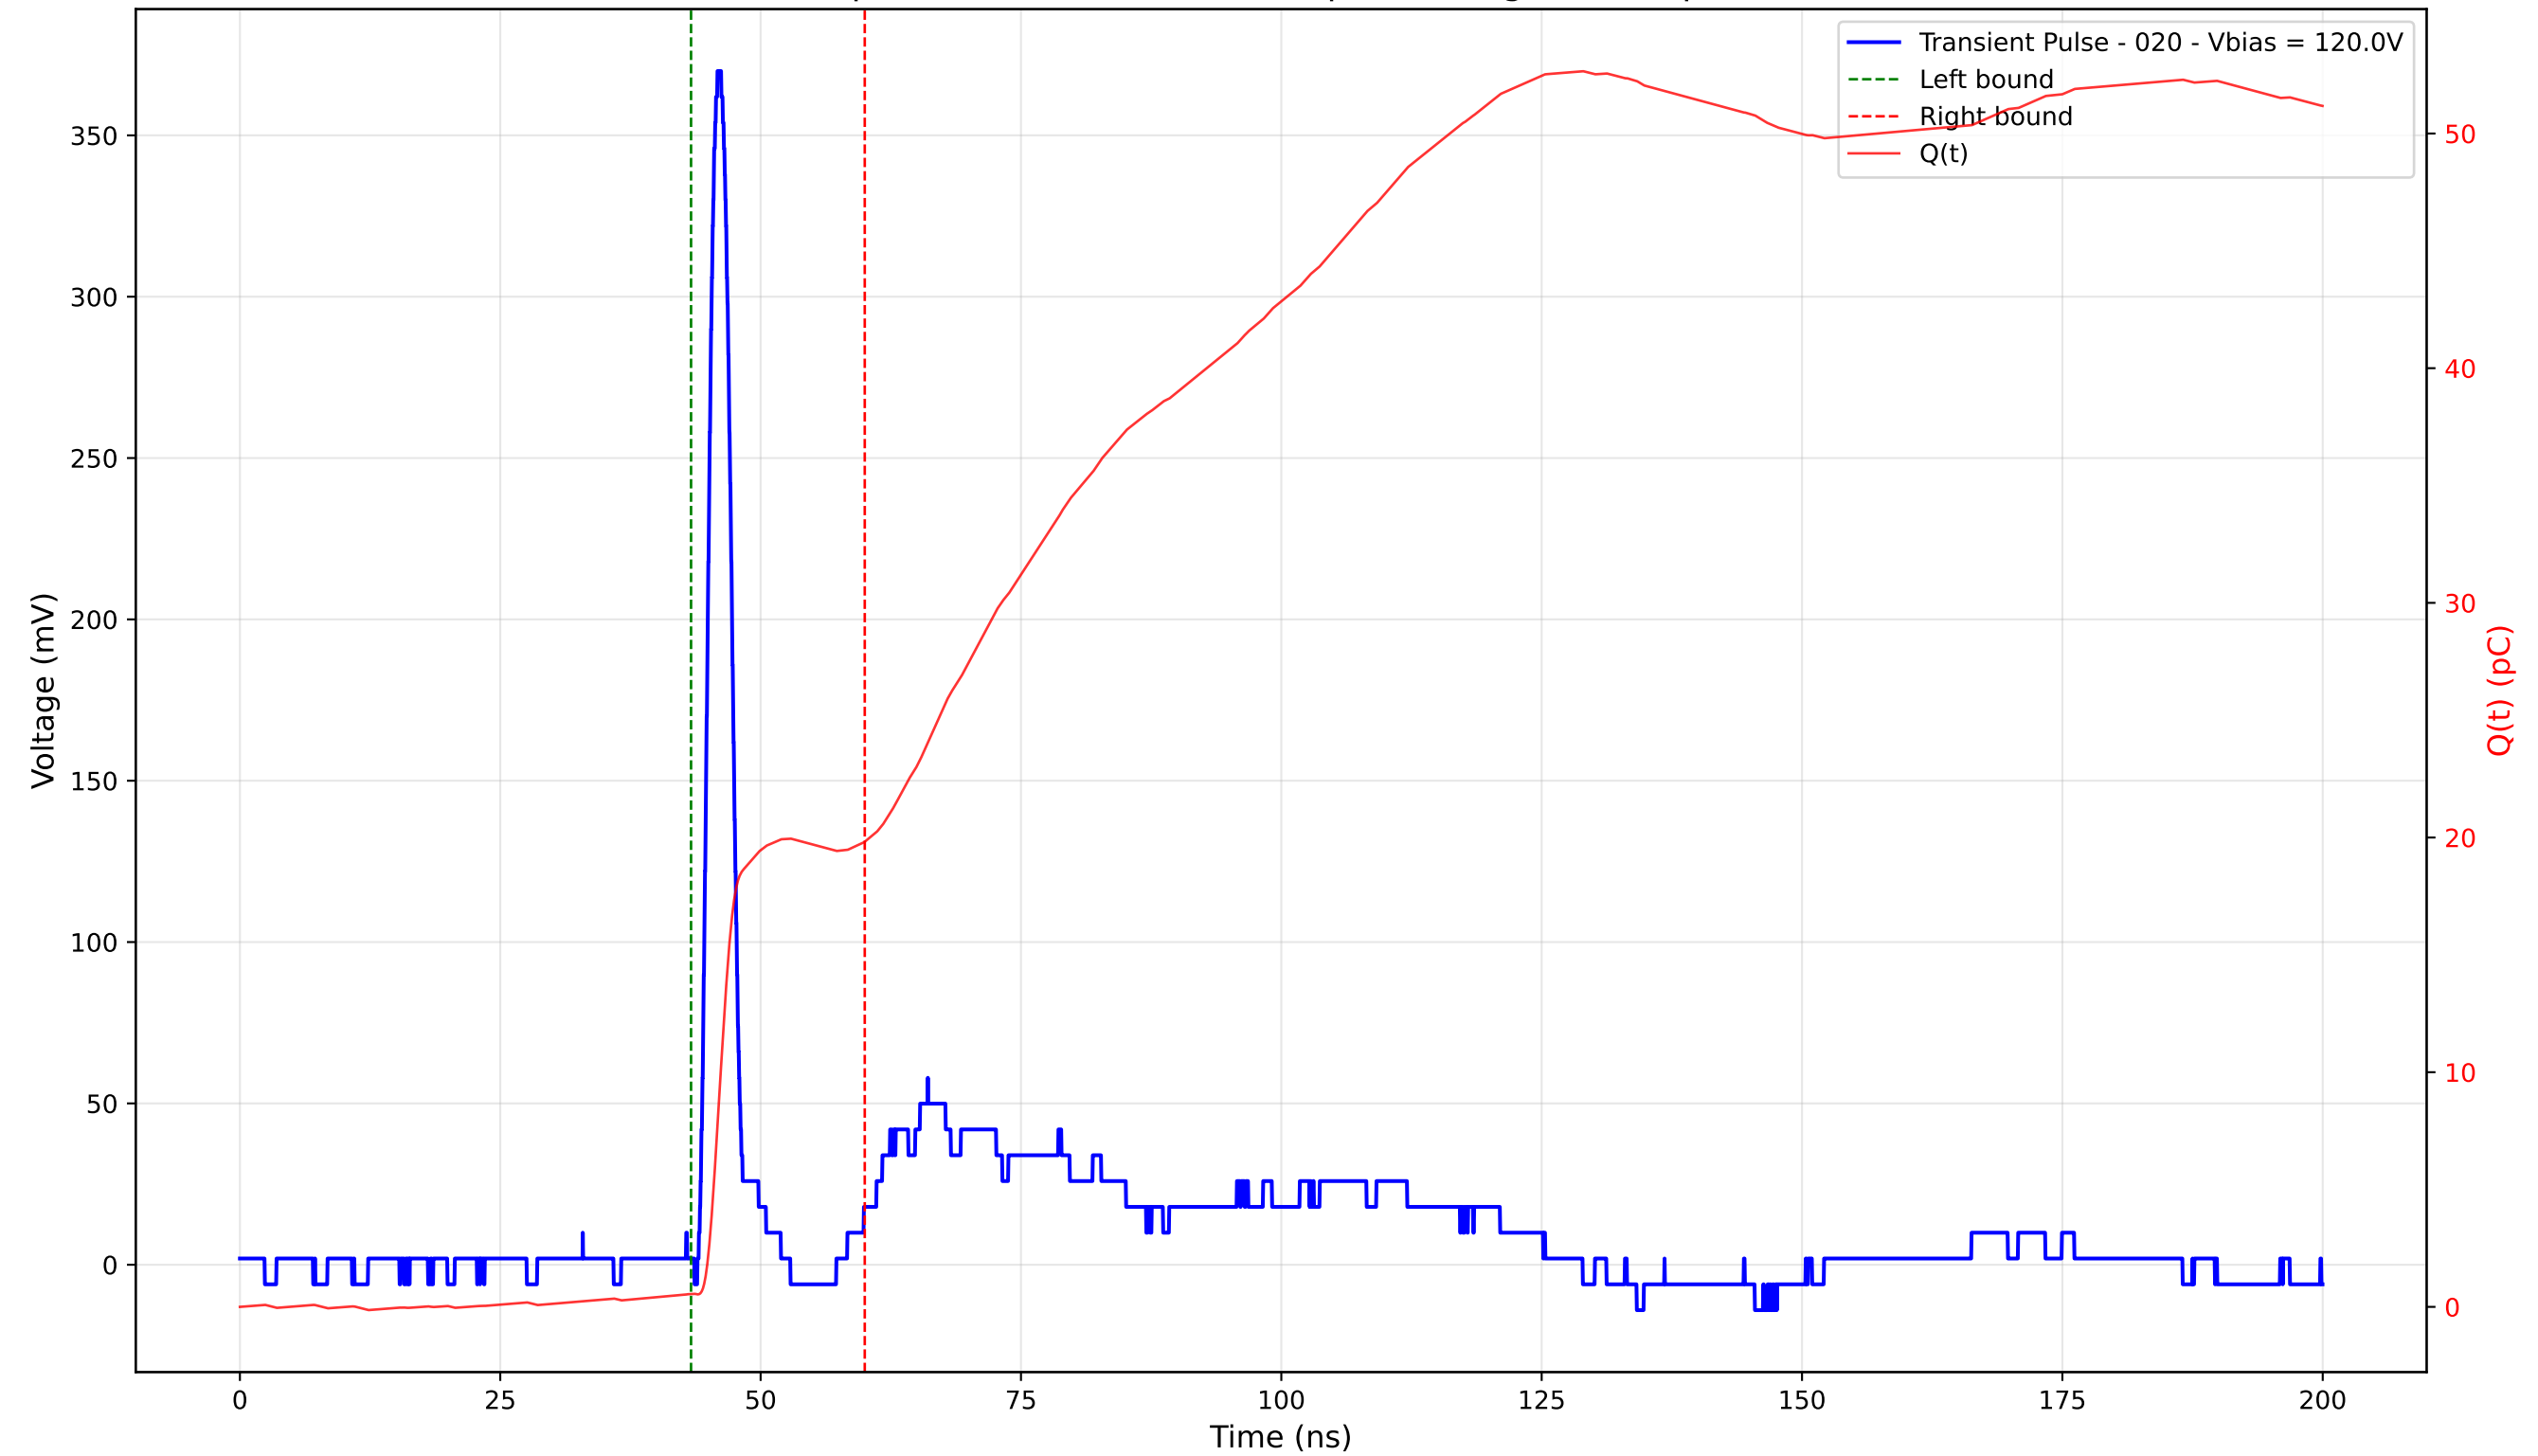


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 19.56 pC - Rise Time: 1.20 ns

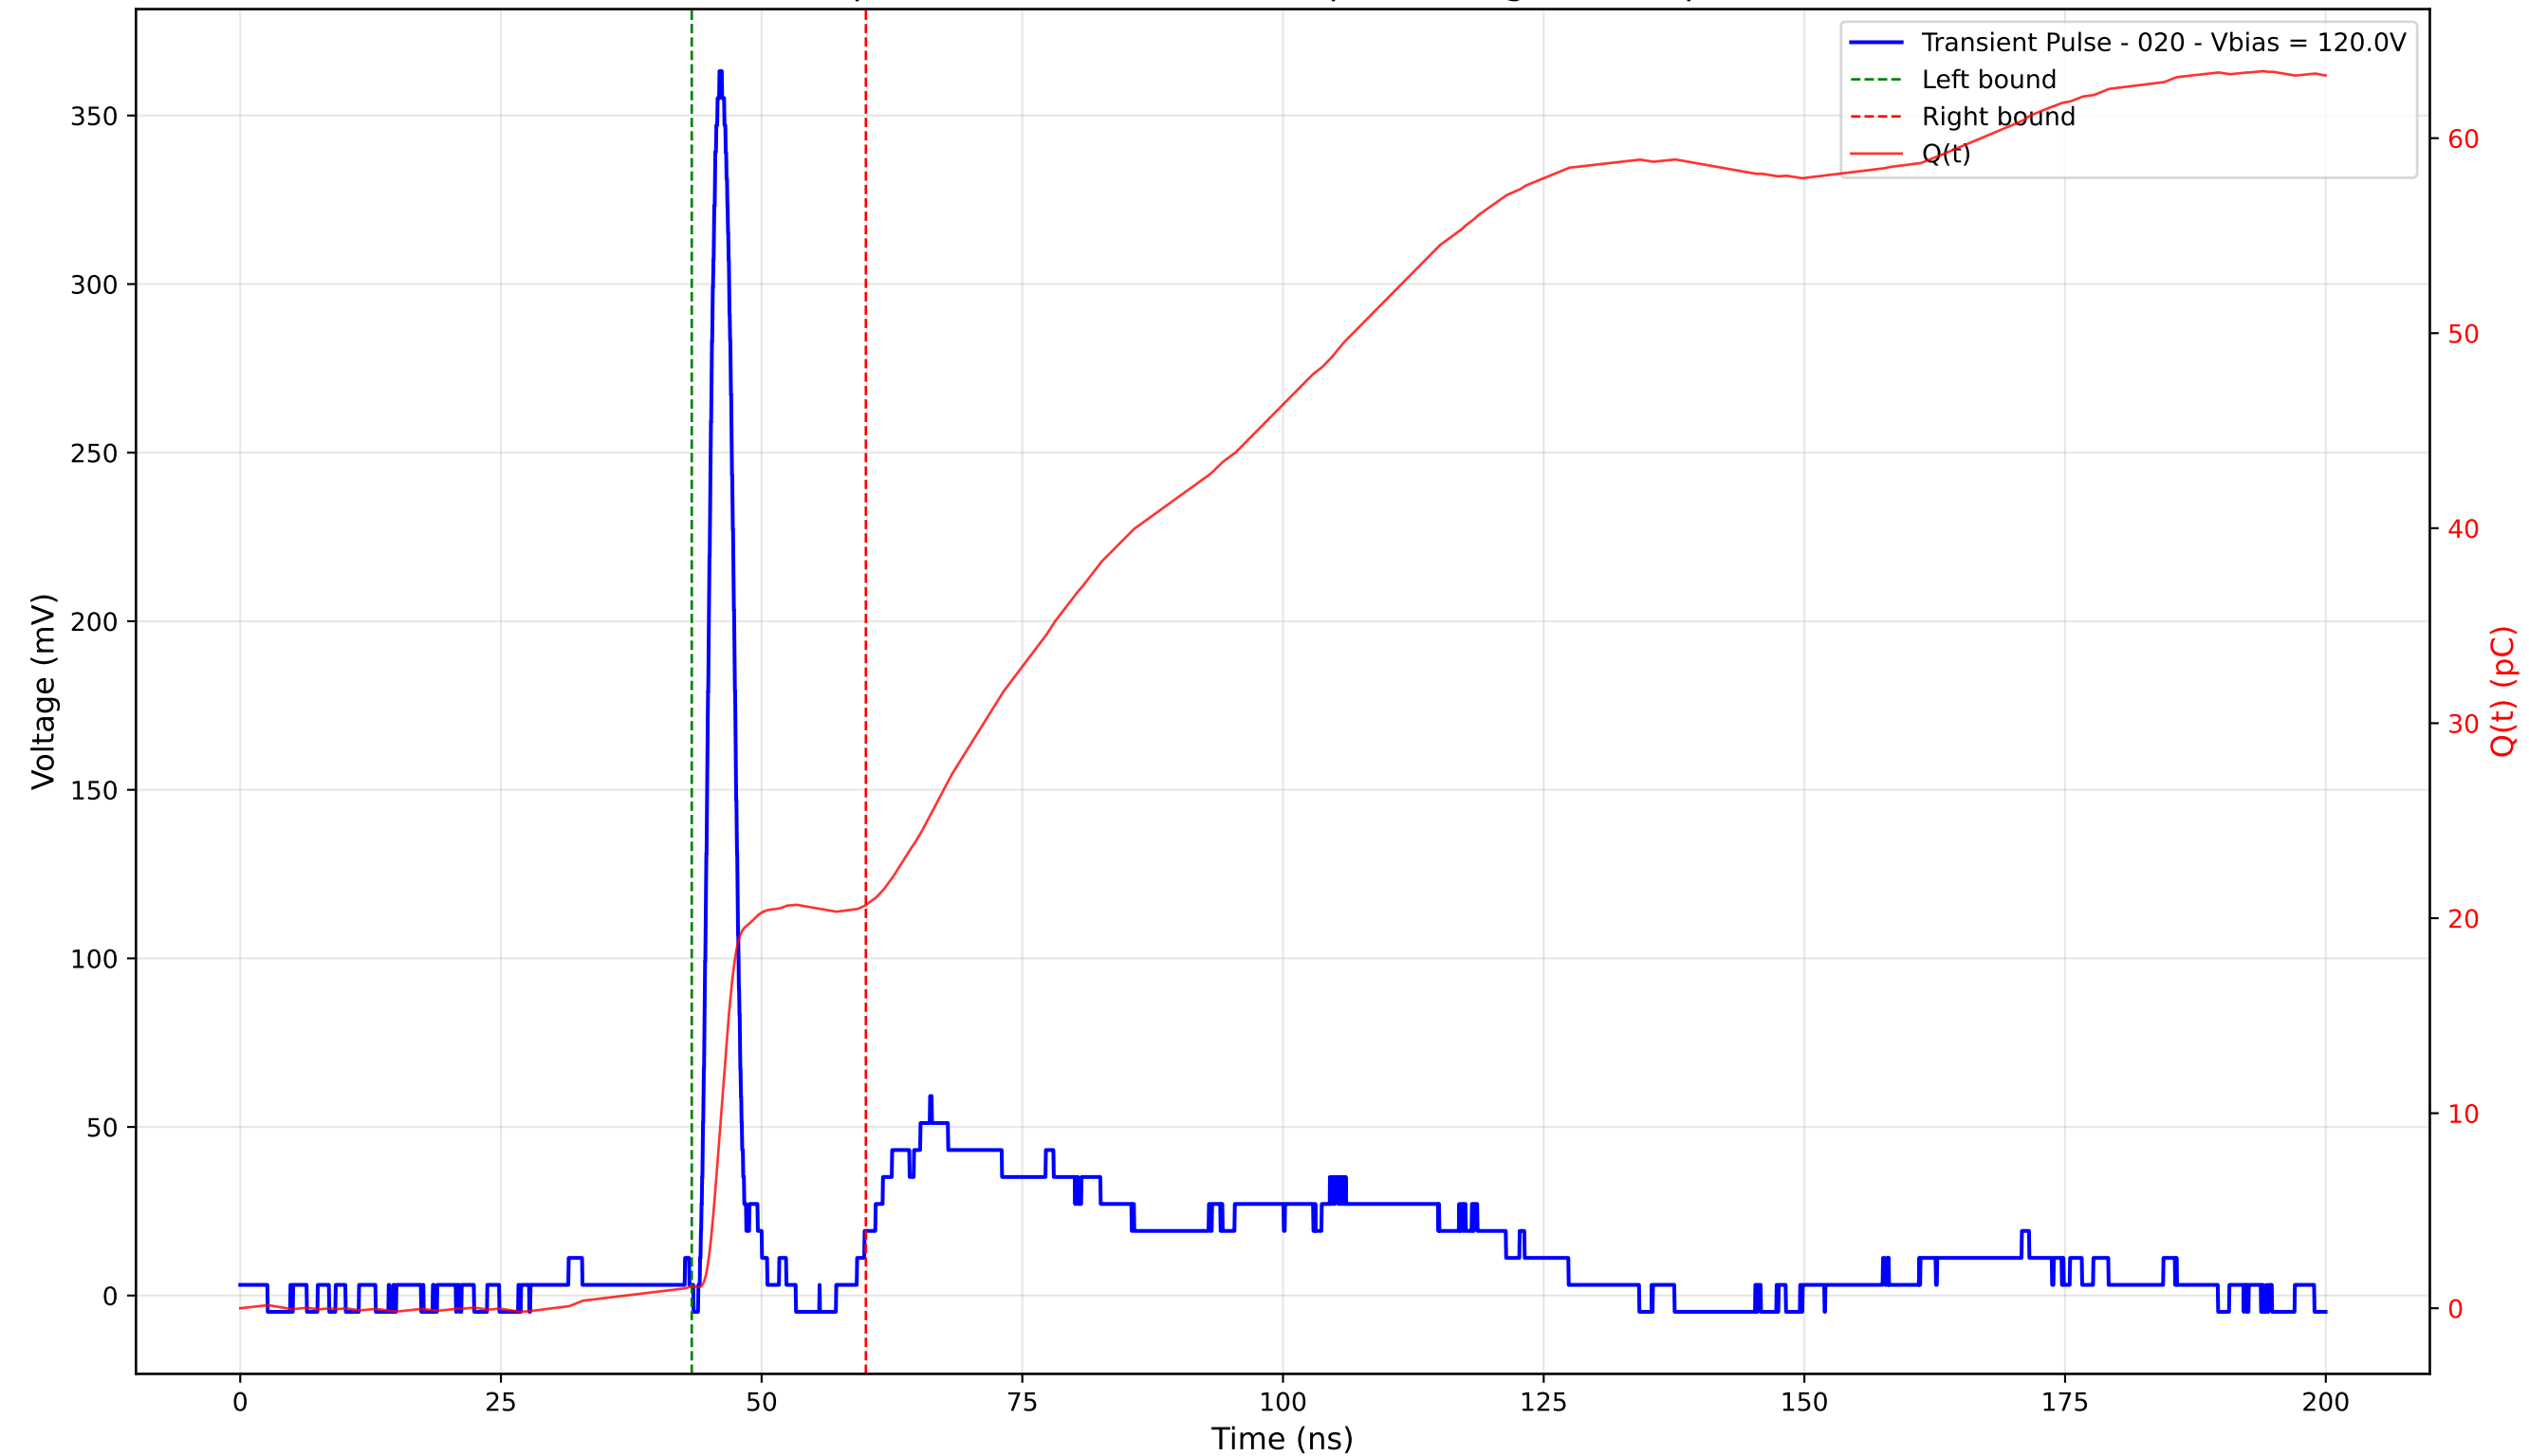


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 18.83 pC - Rise Time: 1.24 ns

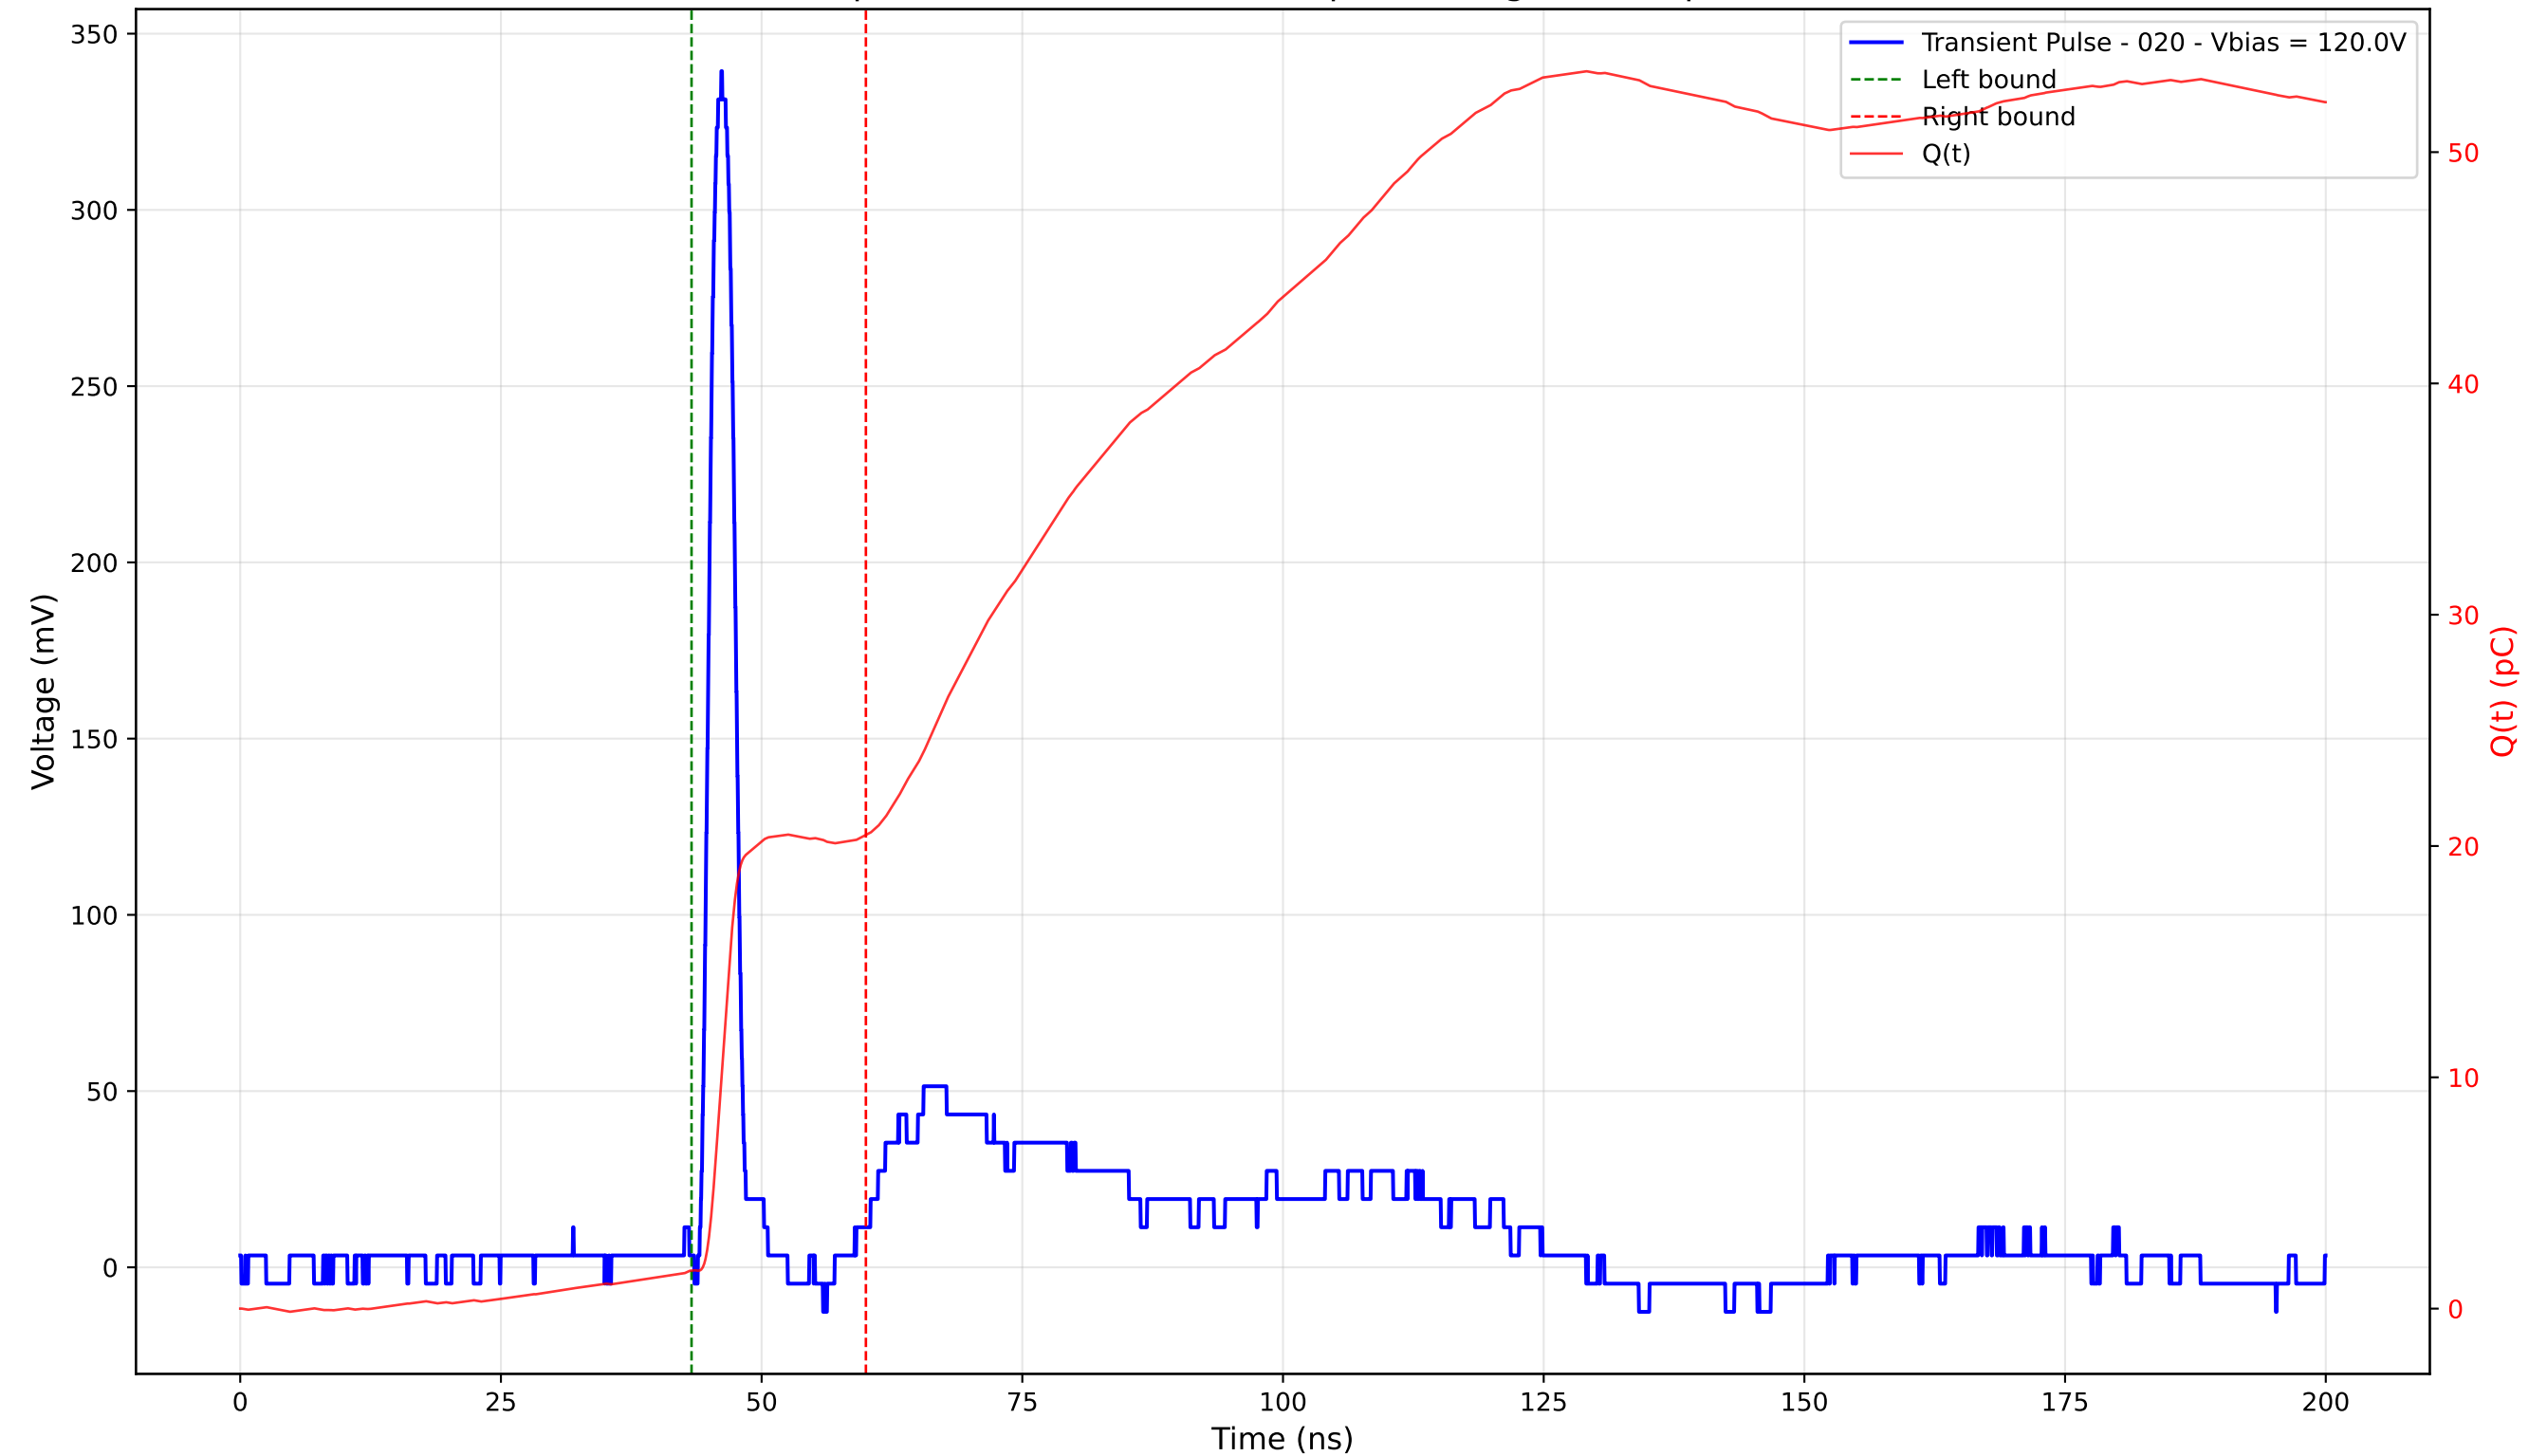


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 18.60 pC - Rise Time: 1.23 ns

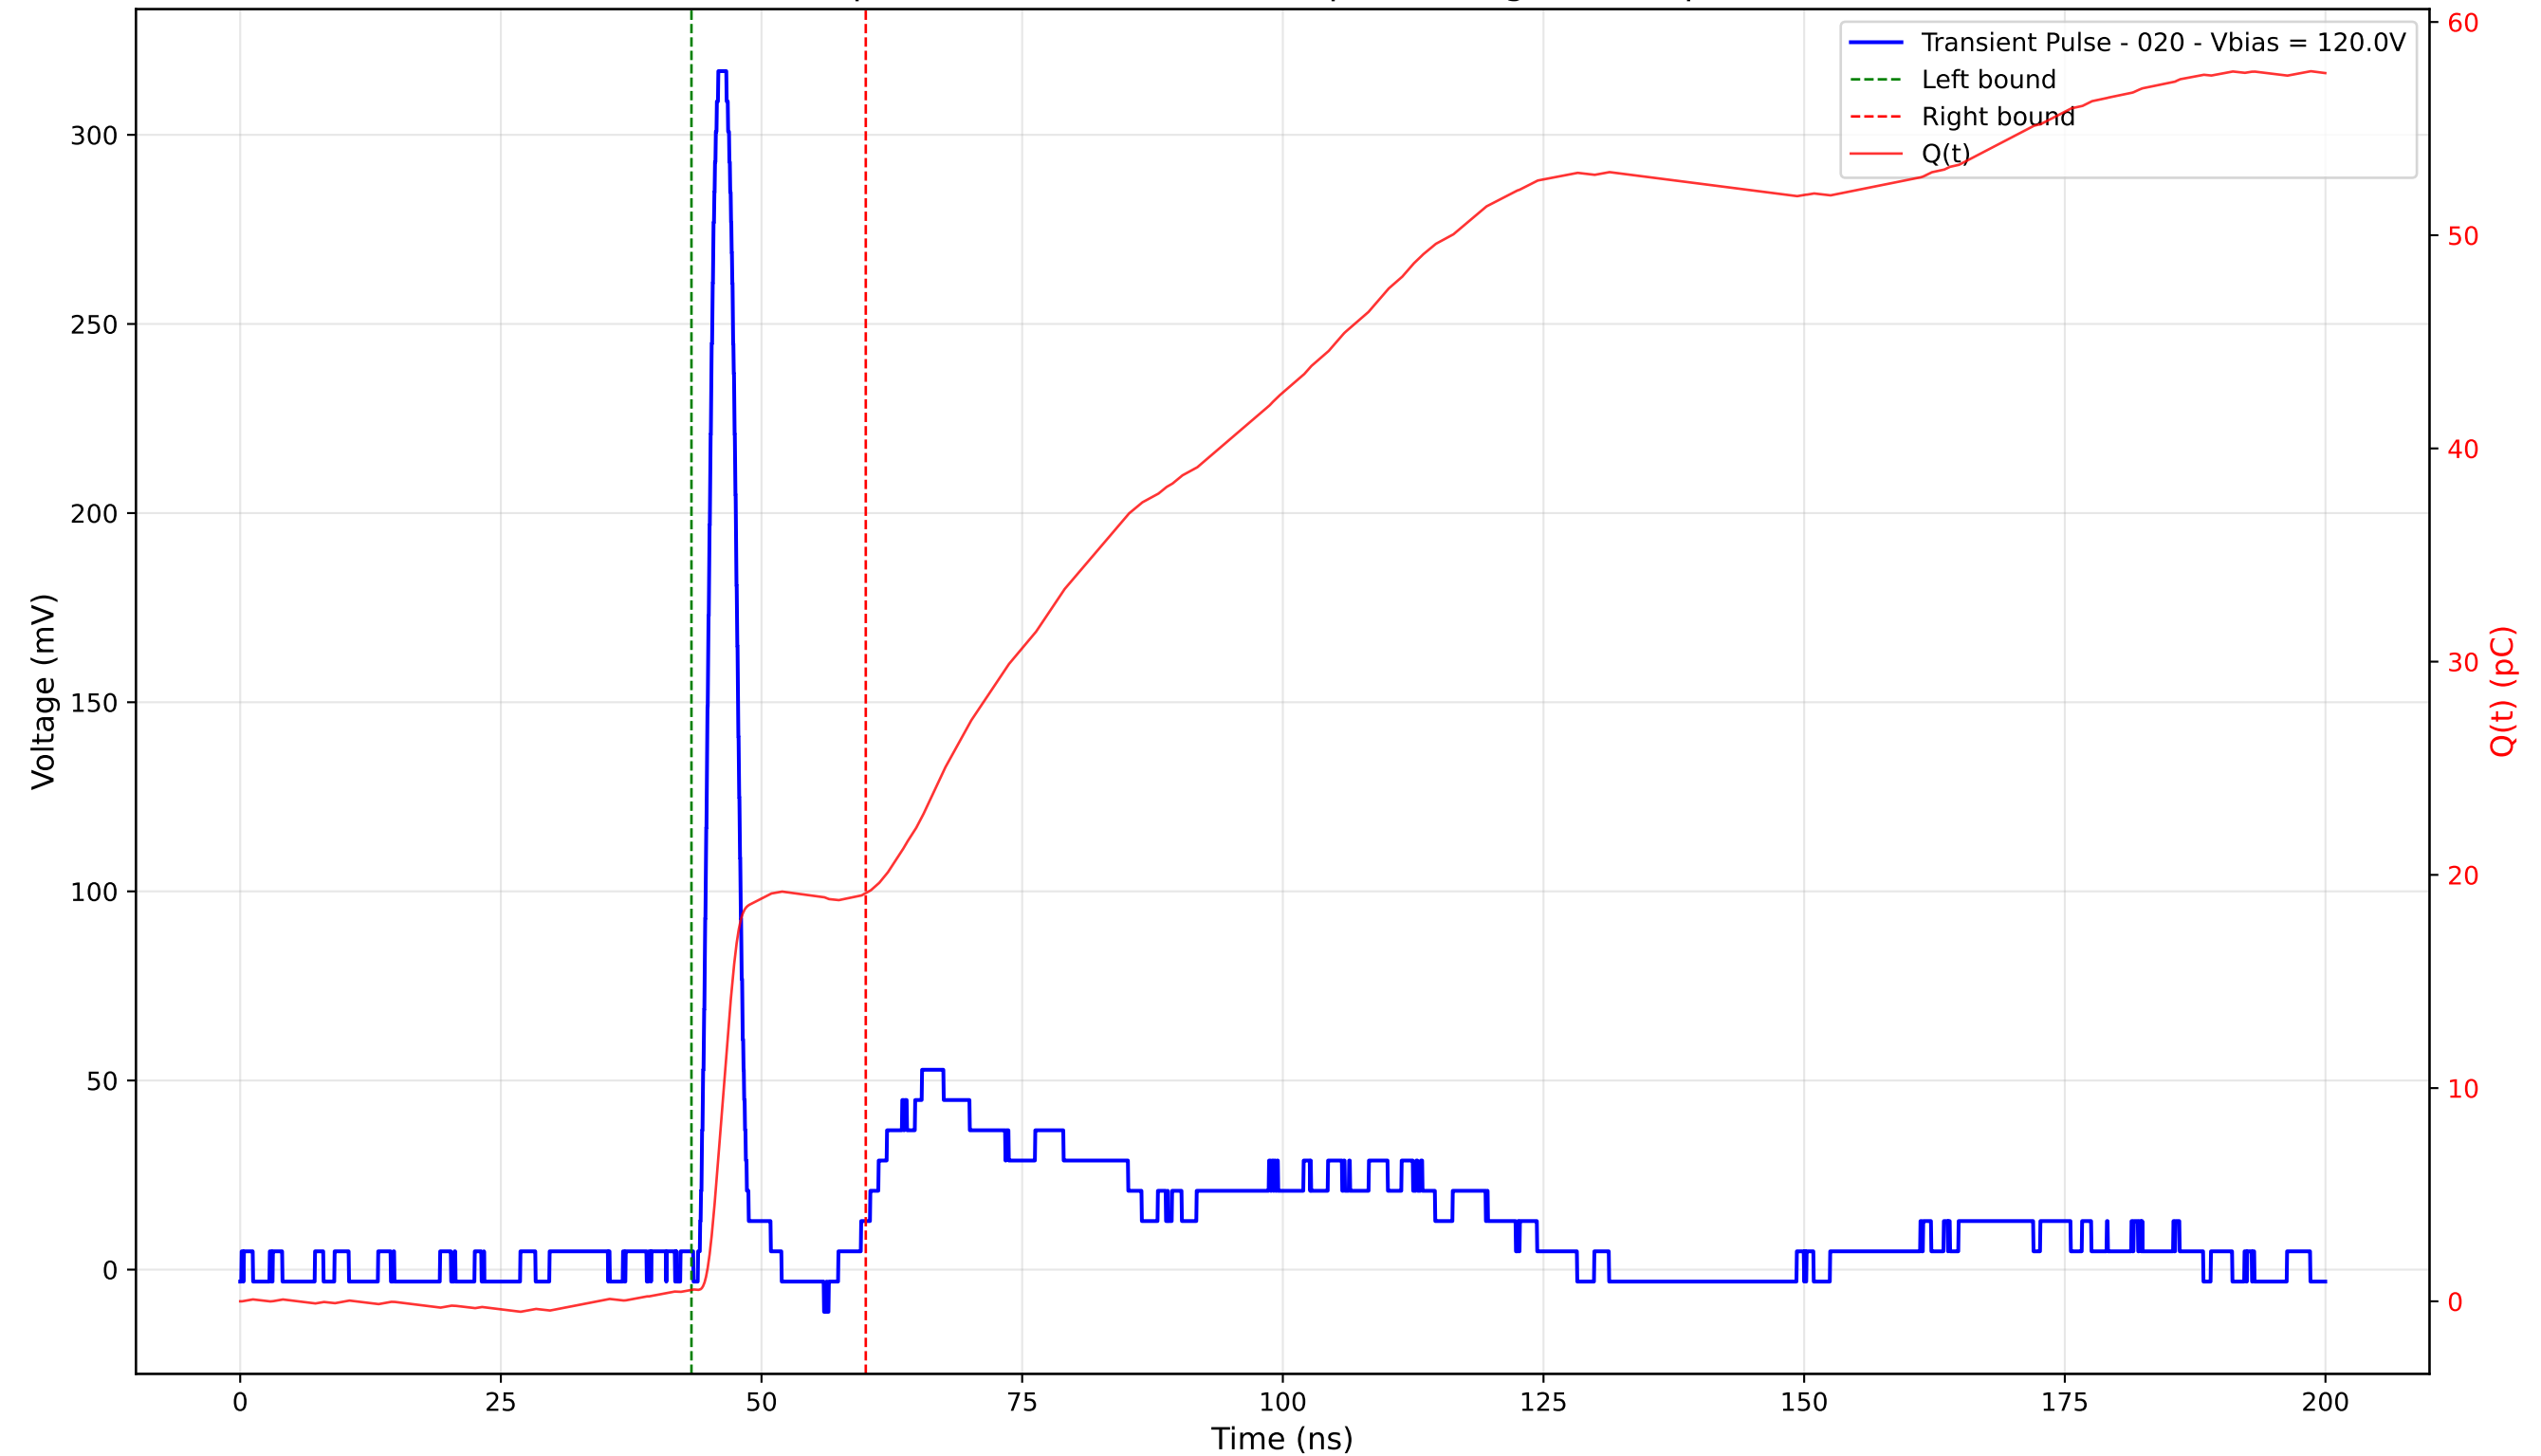


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 18.45 pC - Rise Time: 1.25 ns

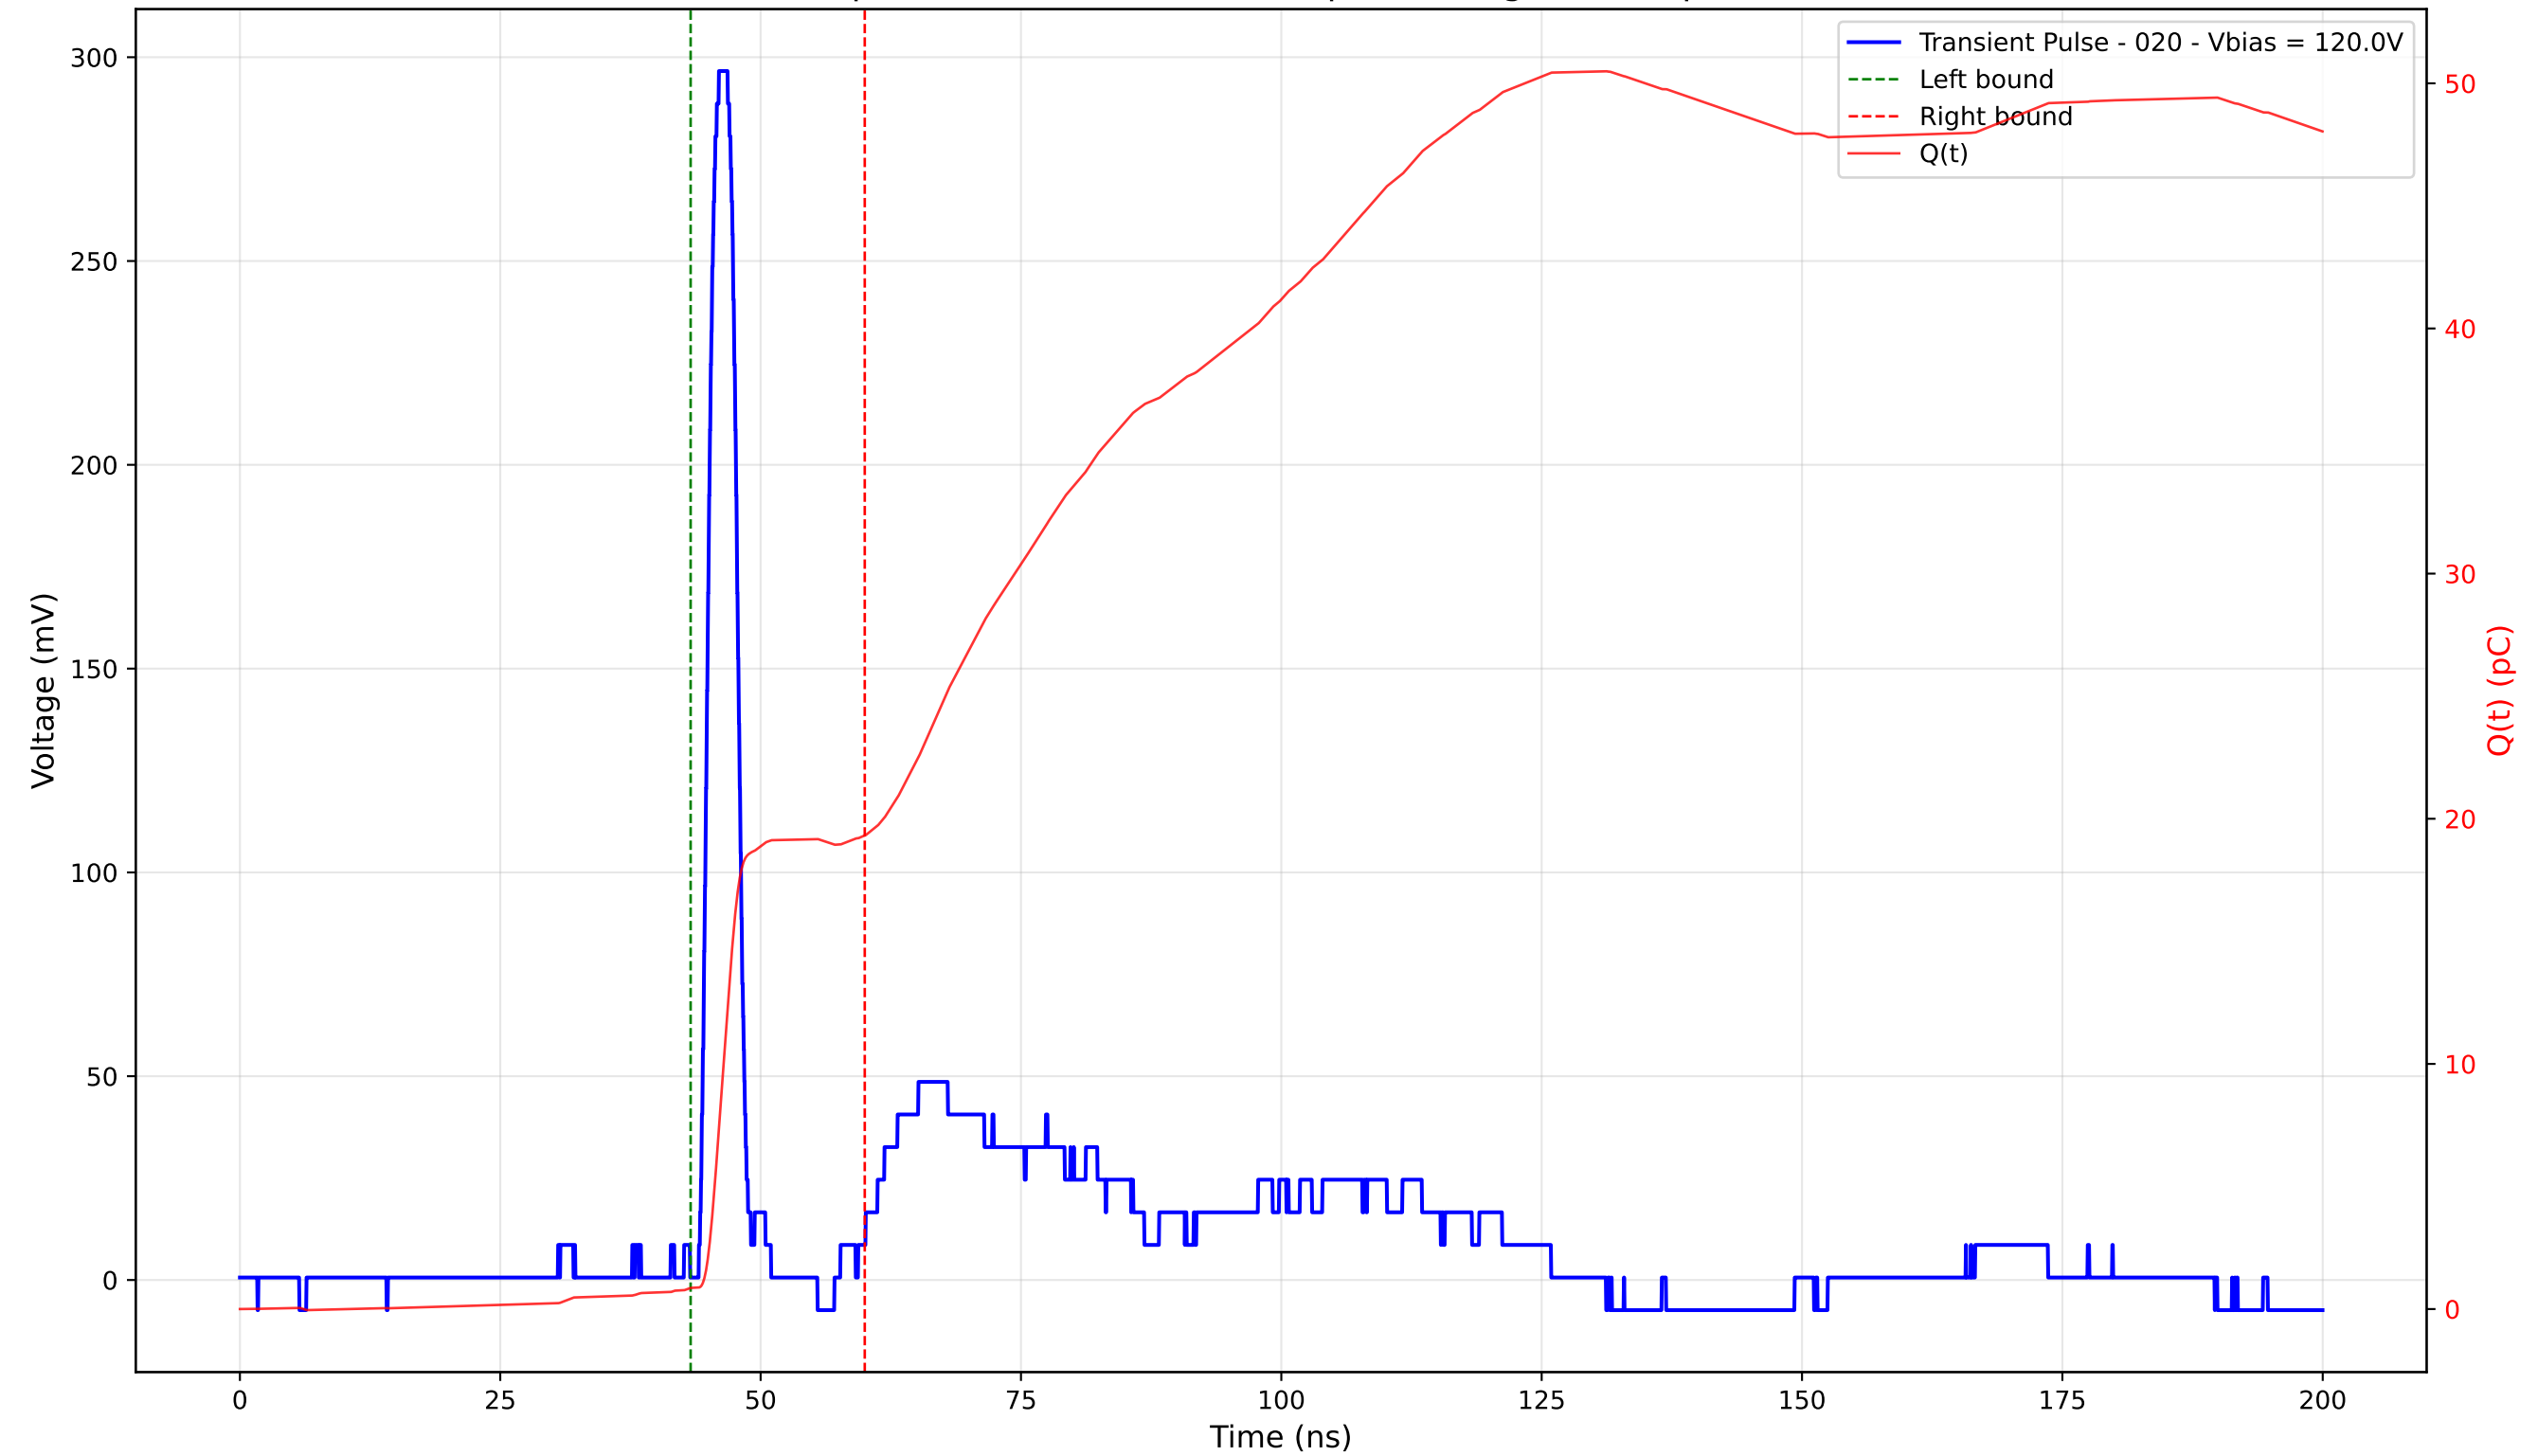


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 17.71 pC - Rise Time: 1.27 ns

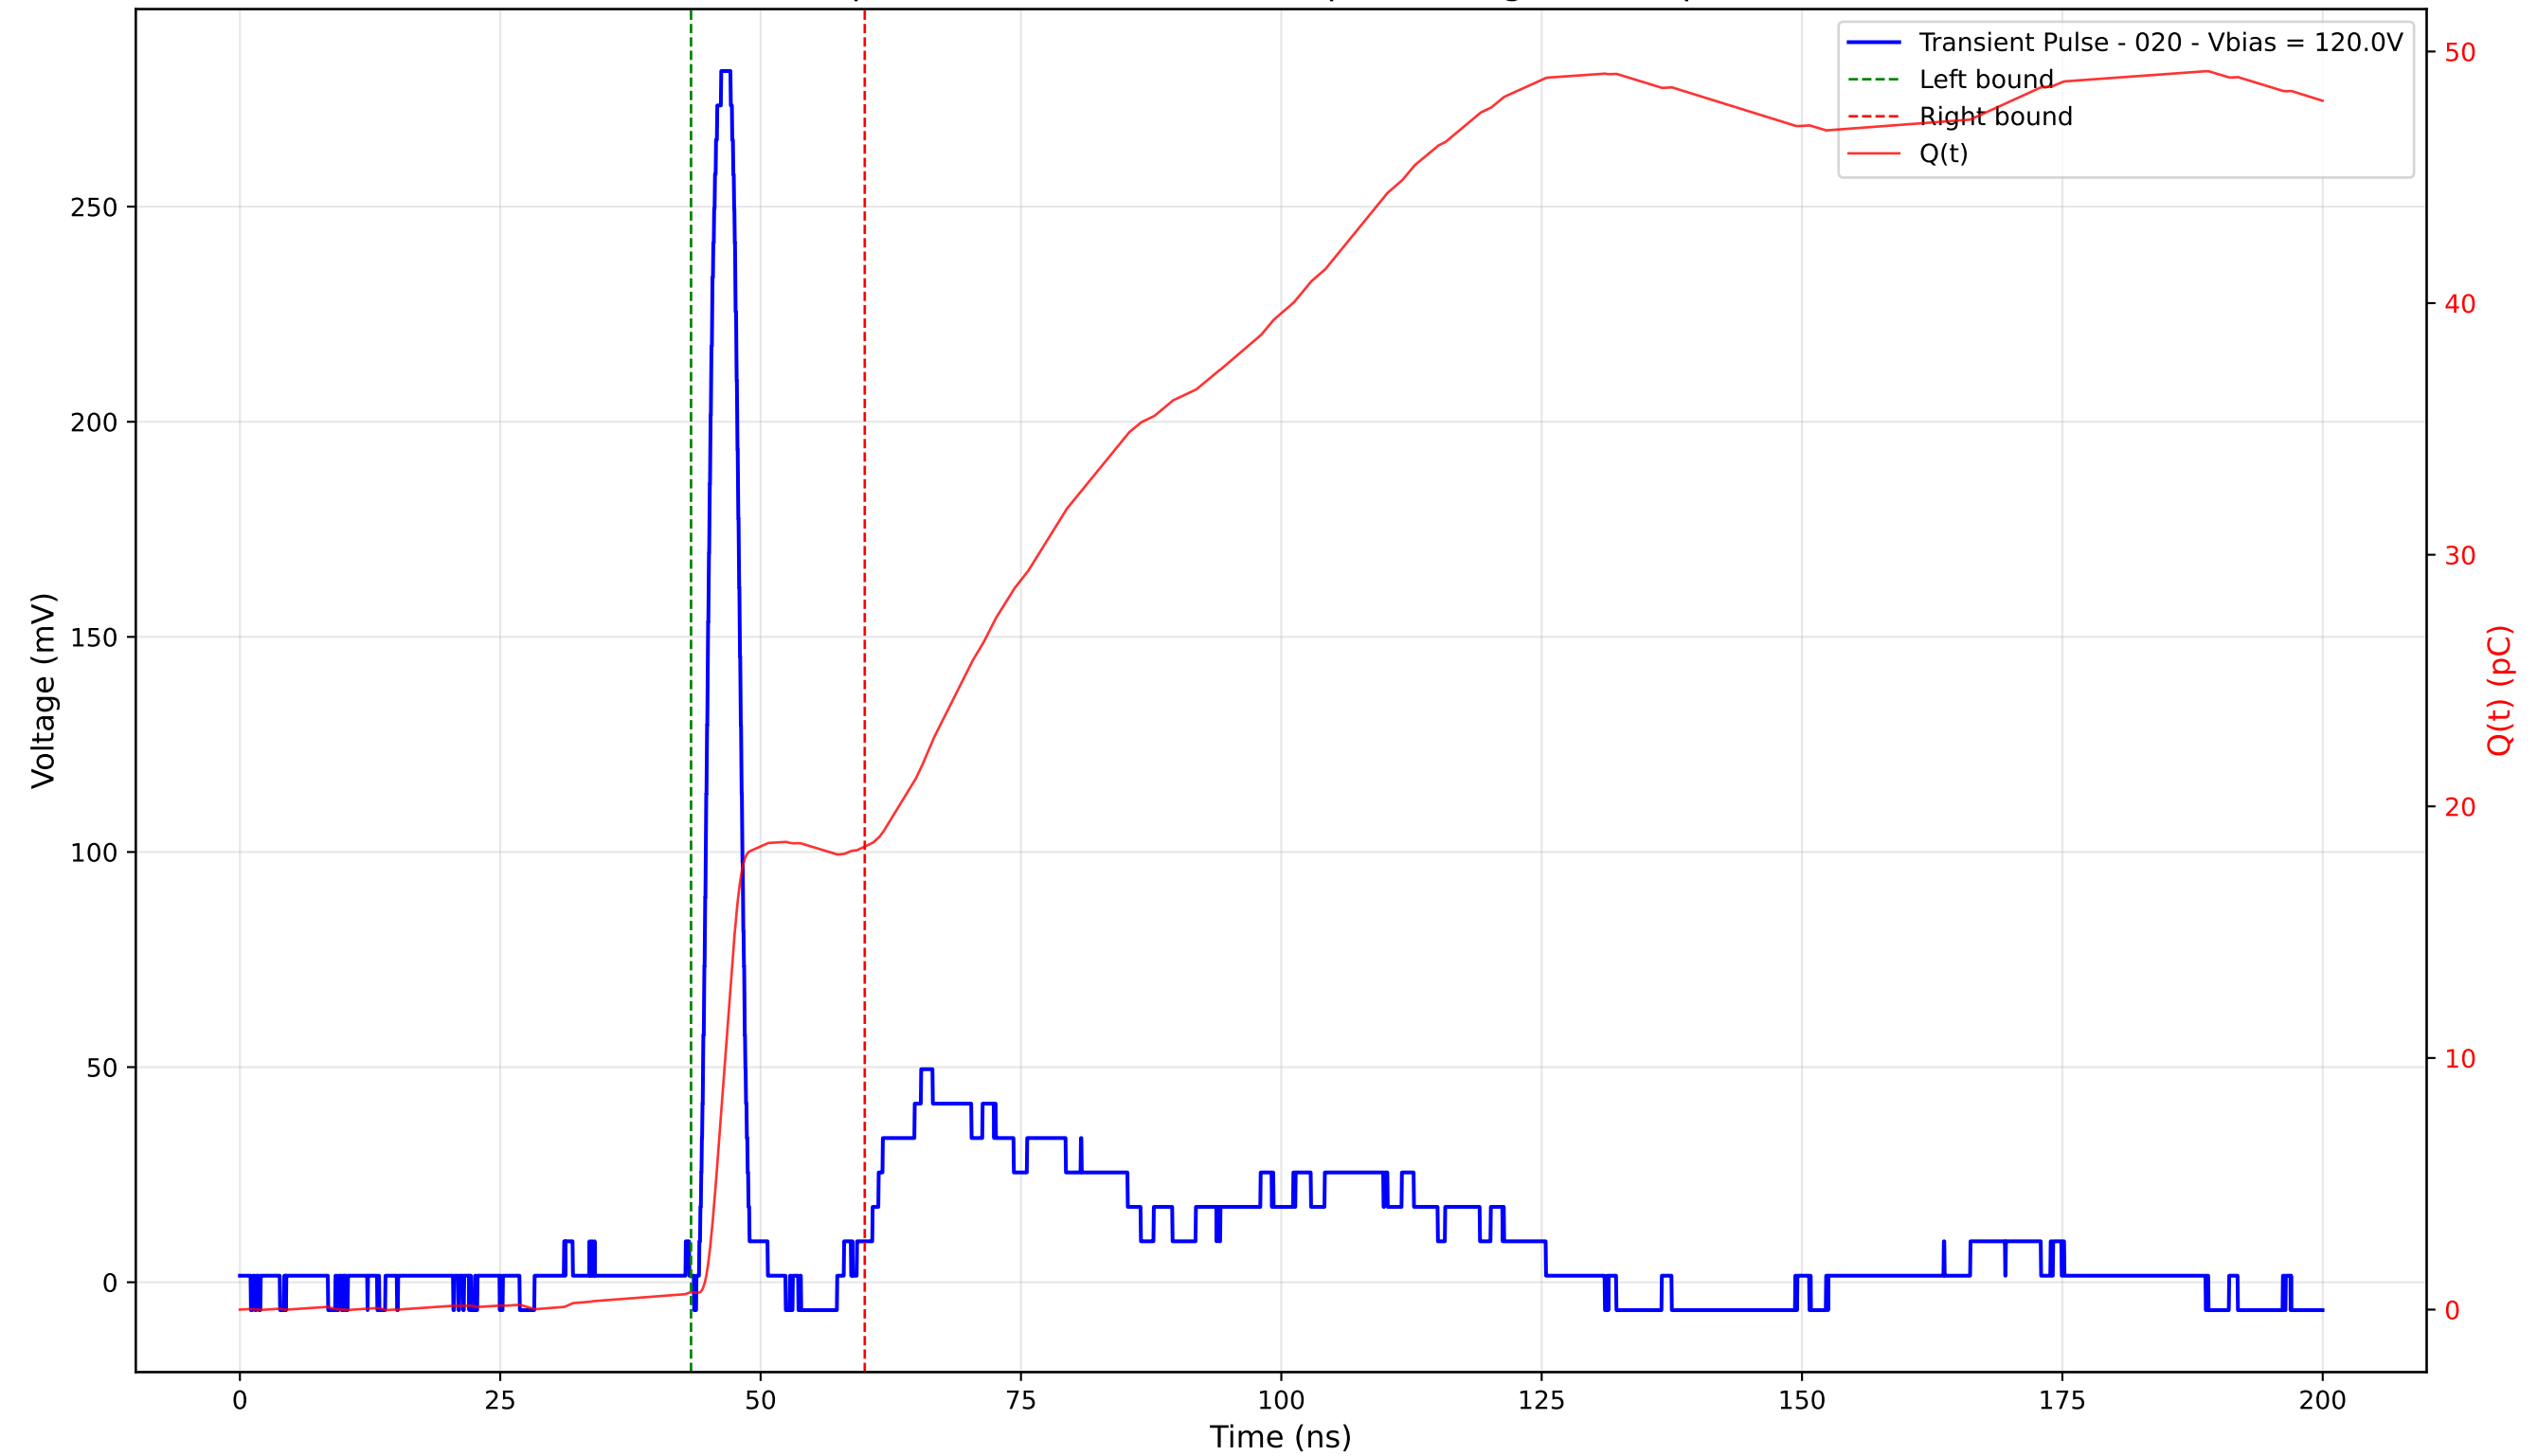


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 16.89 pC - Rise Time: 1.30 ns

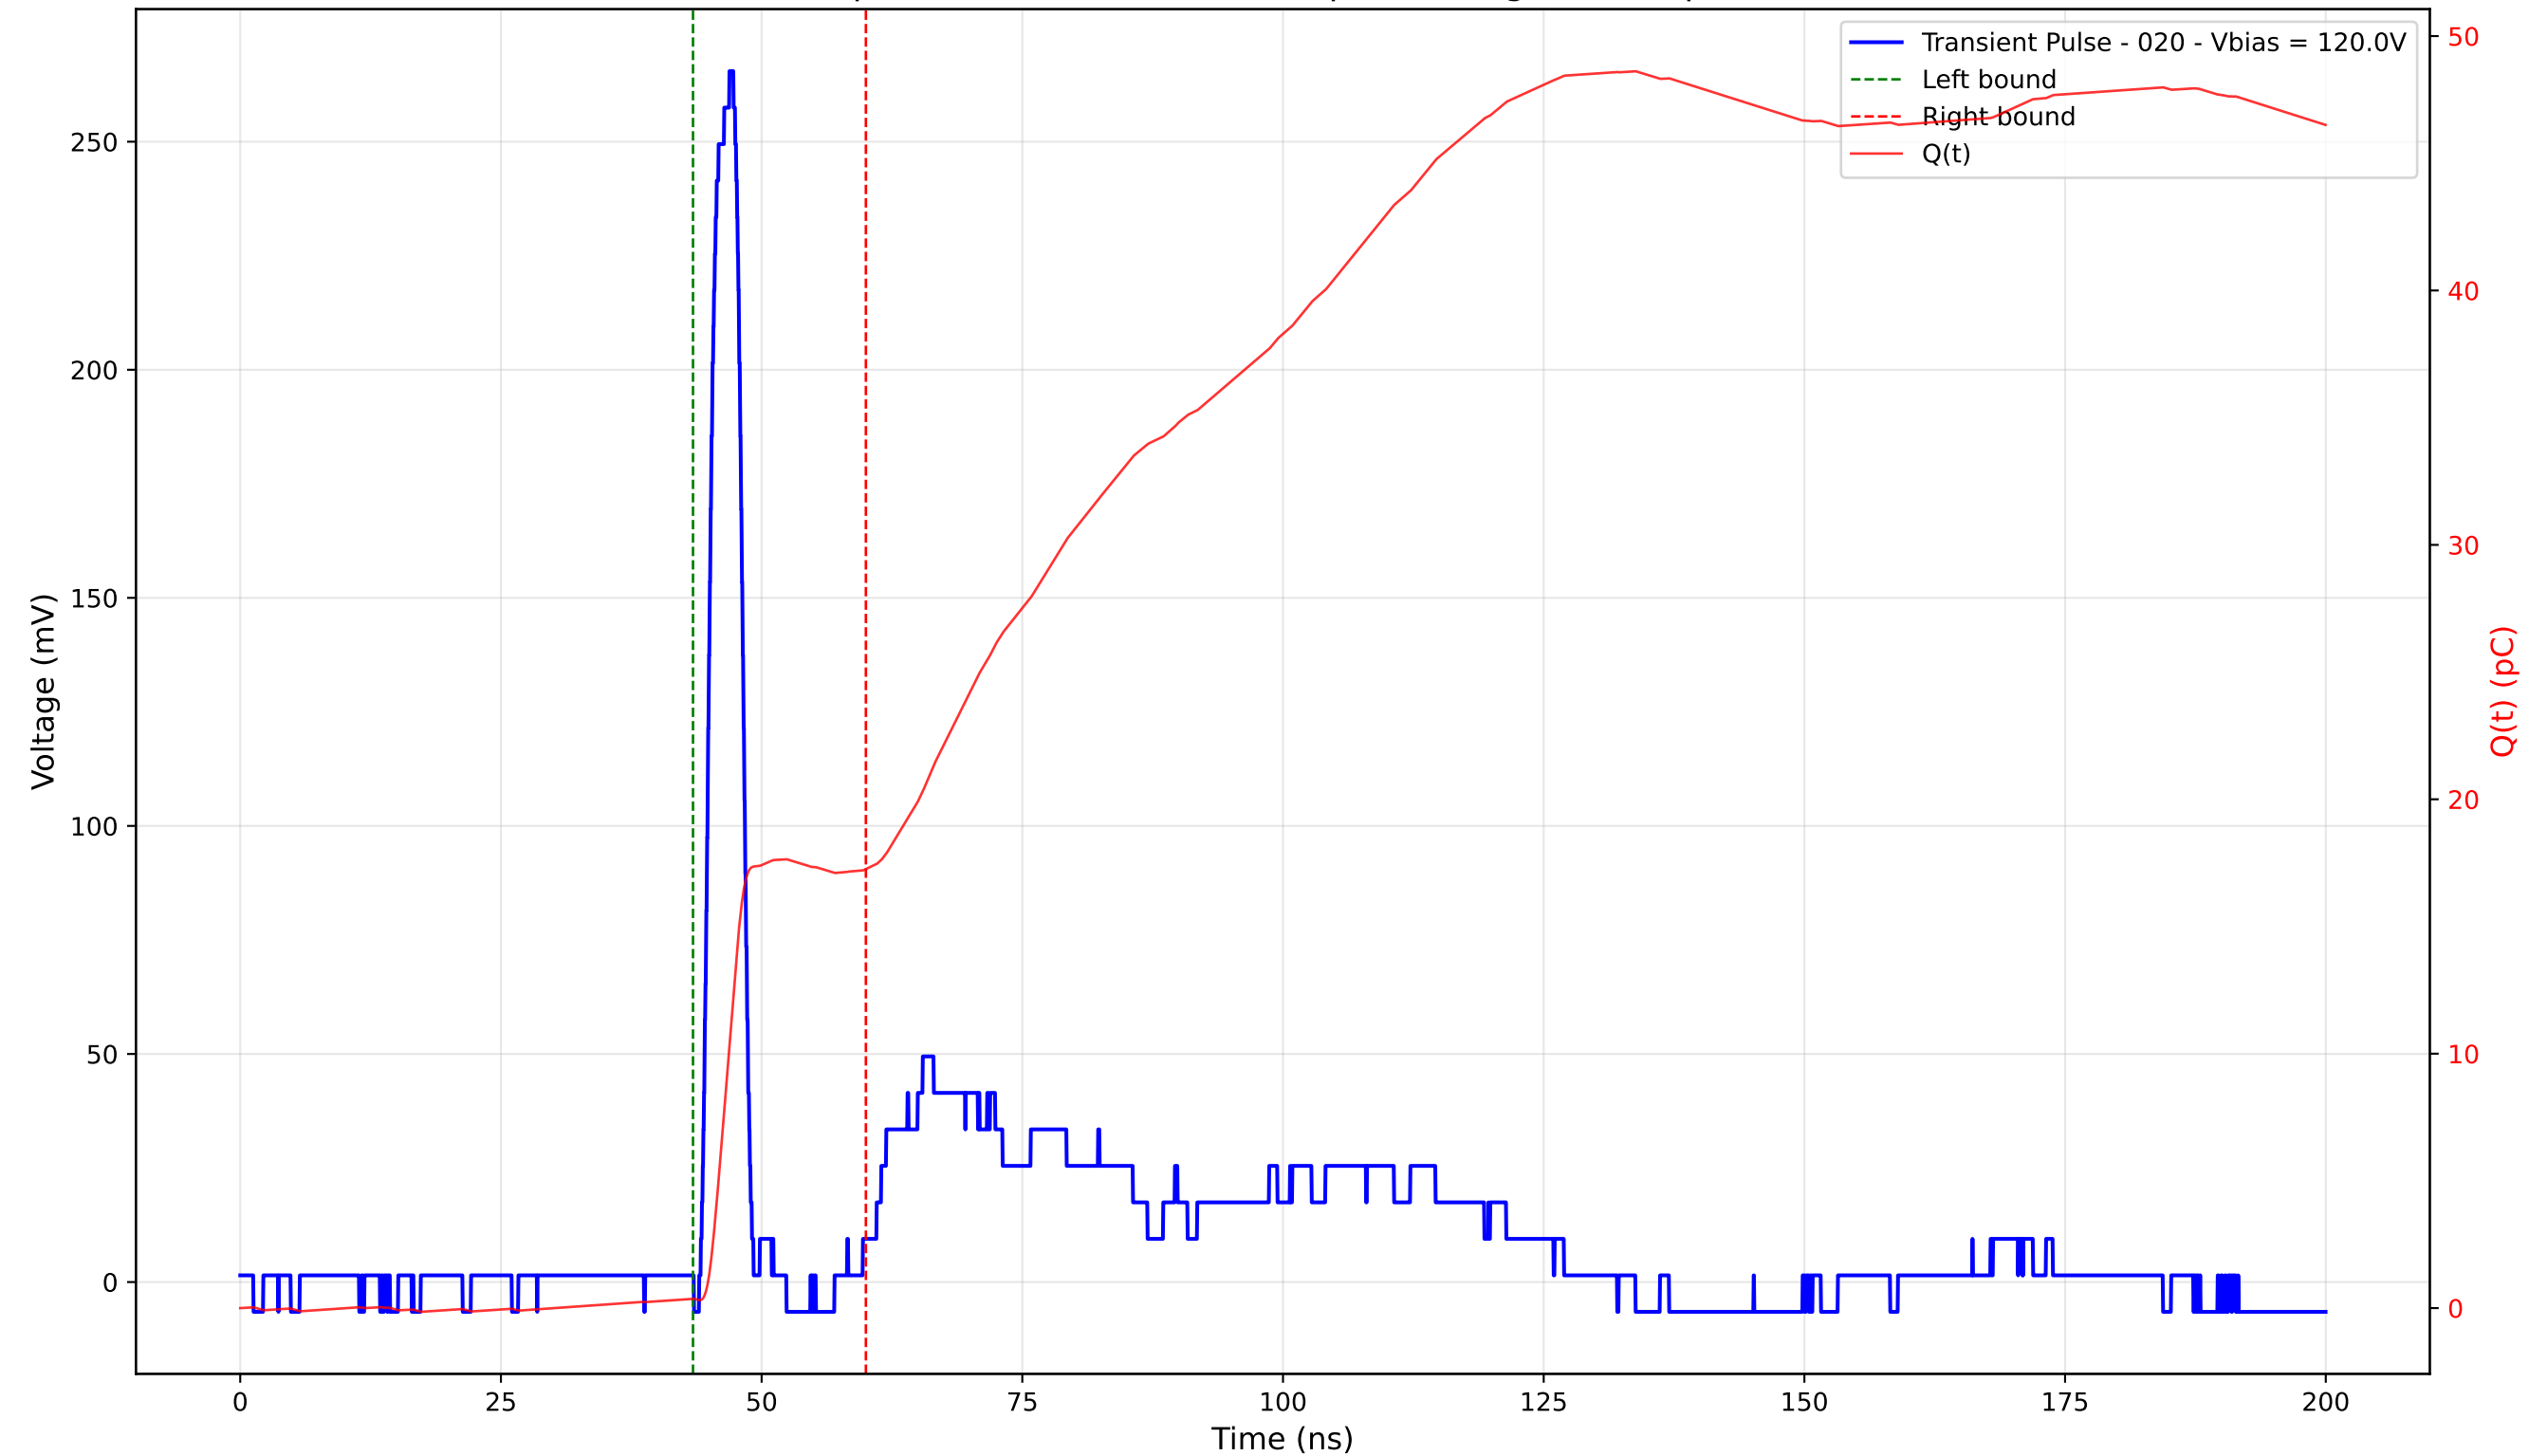


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 16.78 pC - Rise Time: 1.58 ns

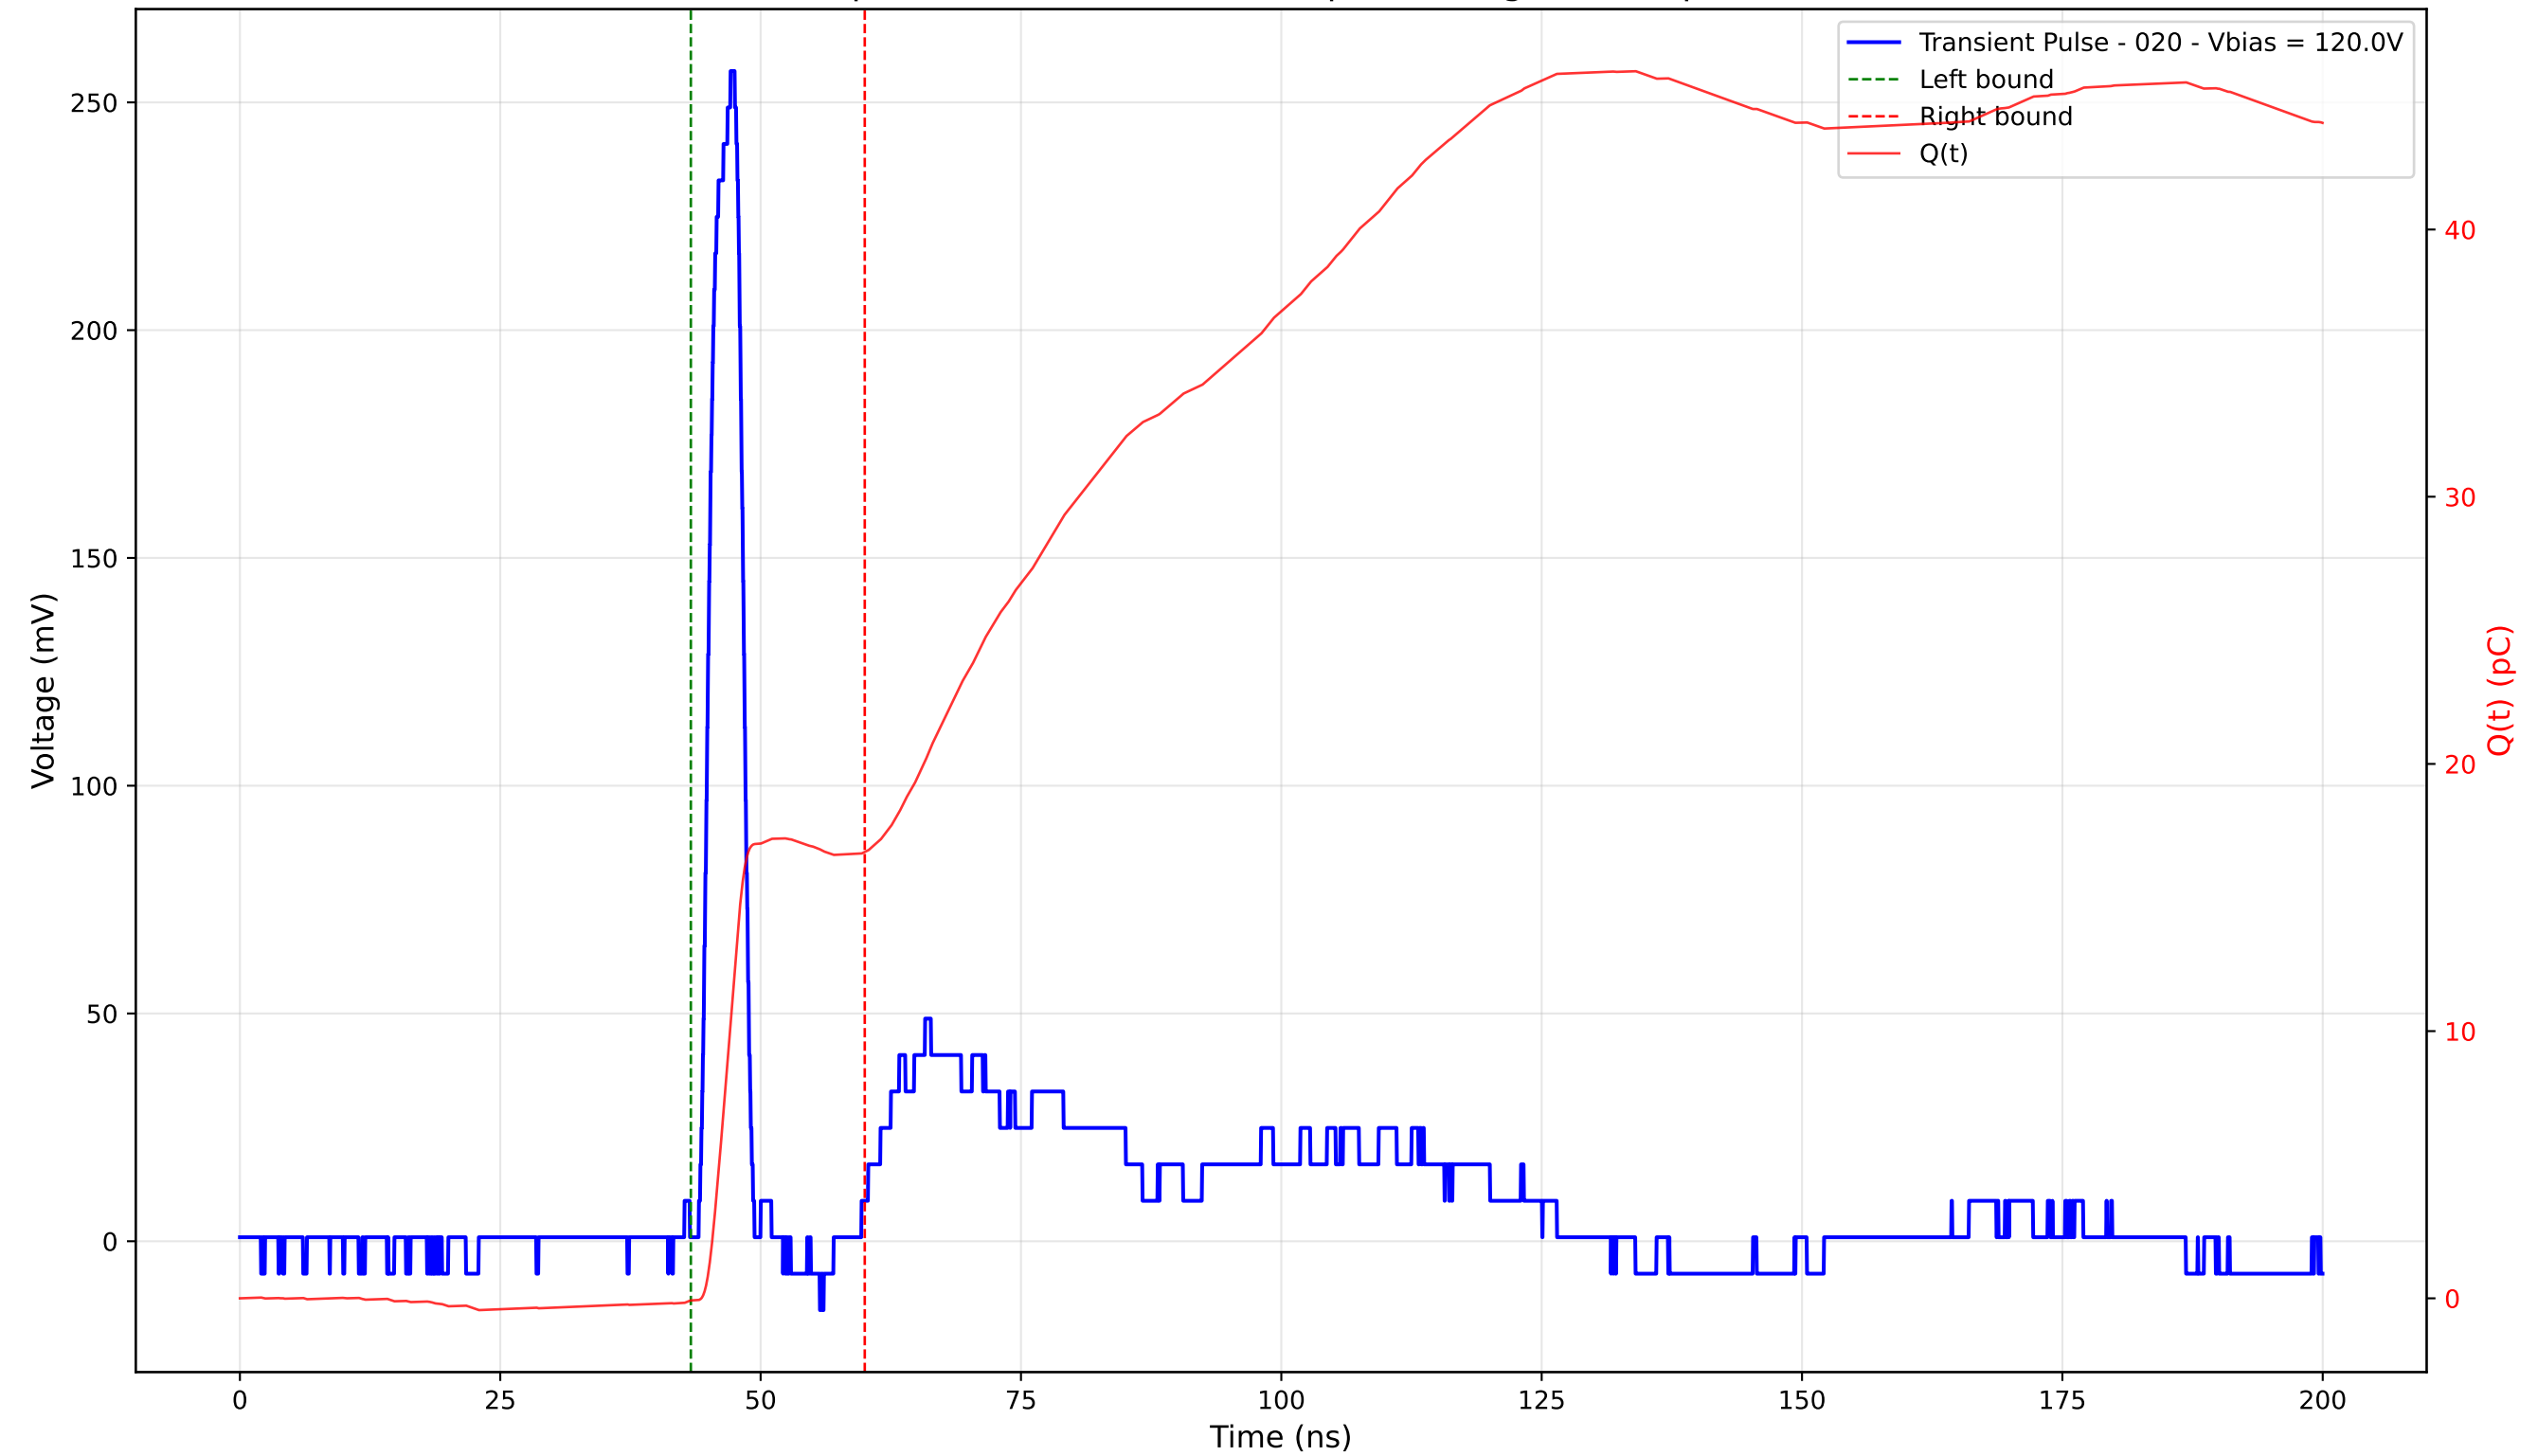


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 17.22 pC - Rise Time: 2.18 ns

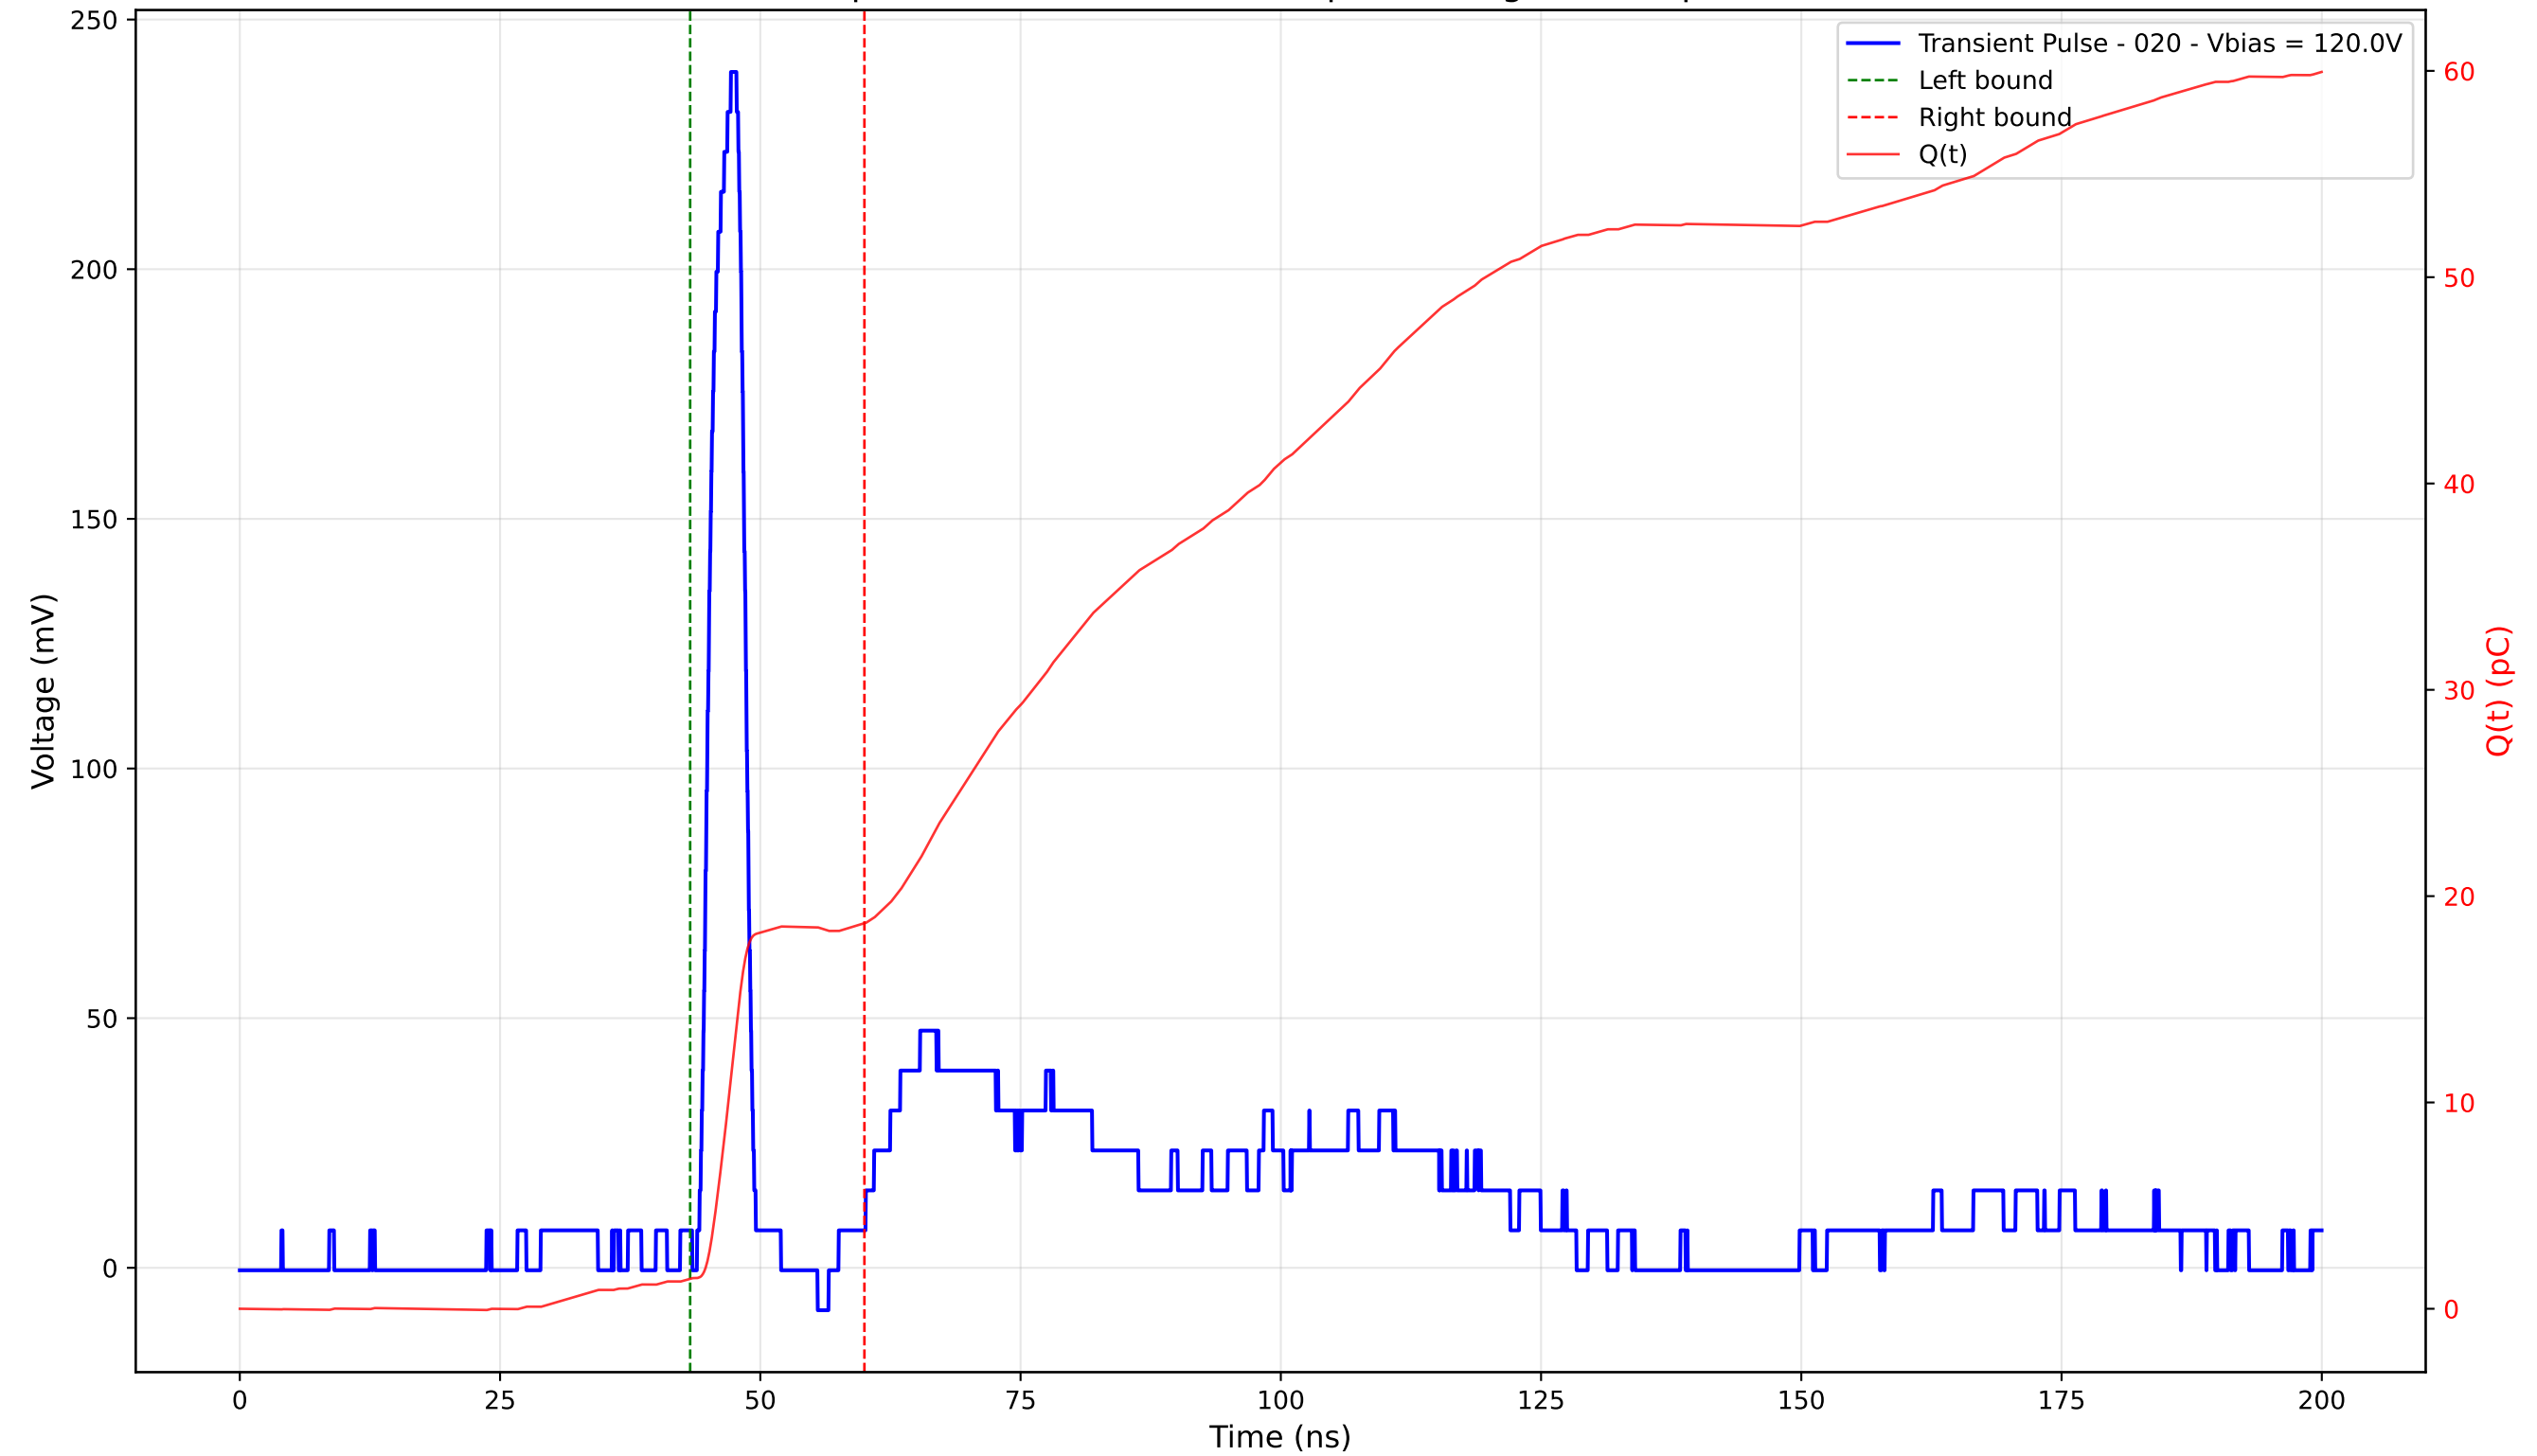


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 16.48 pC - Rise Time: 2.52 ns

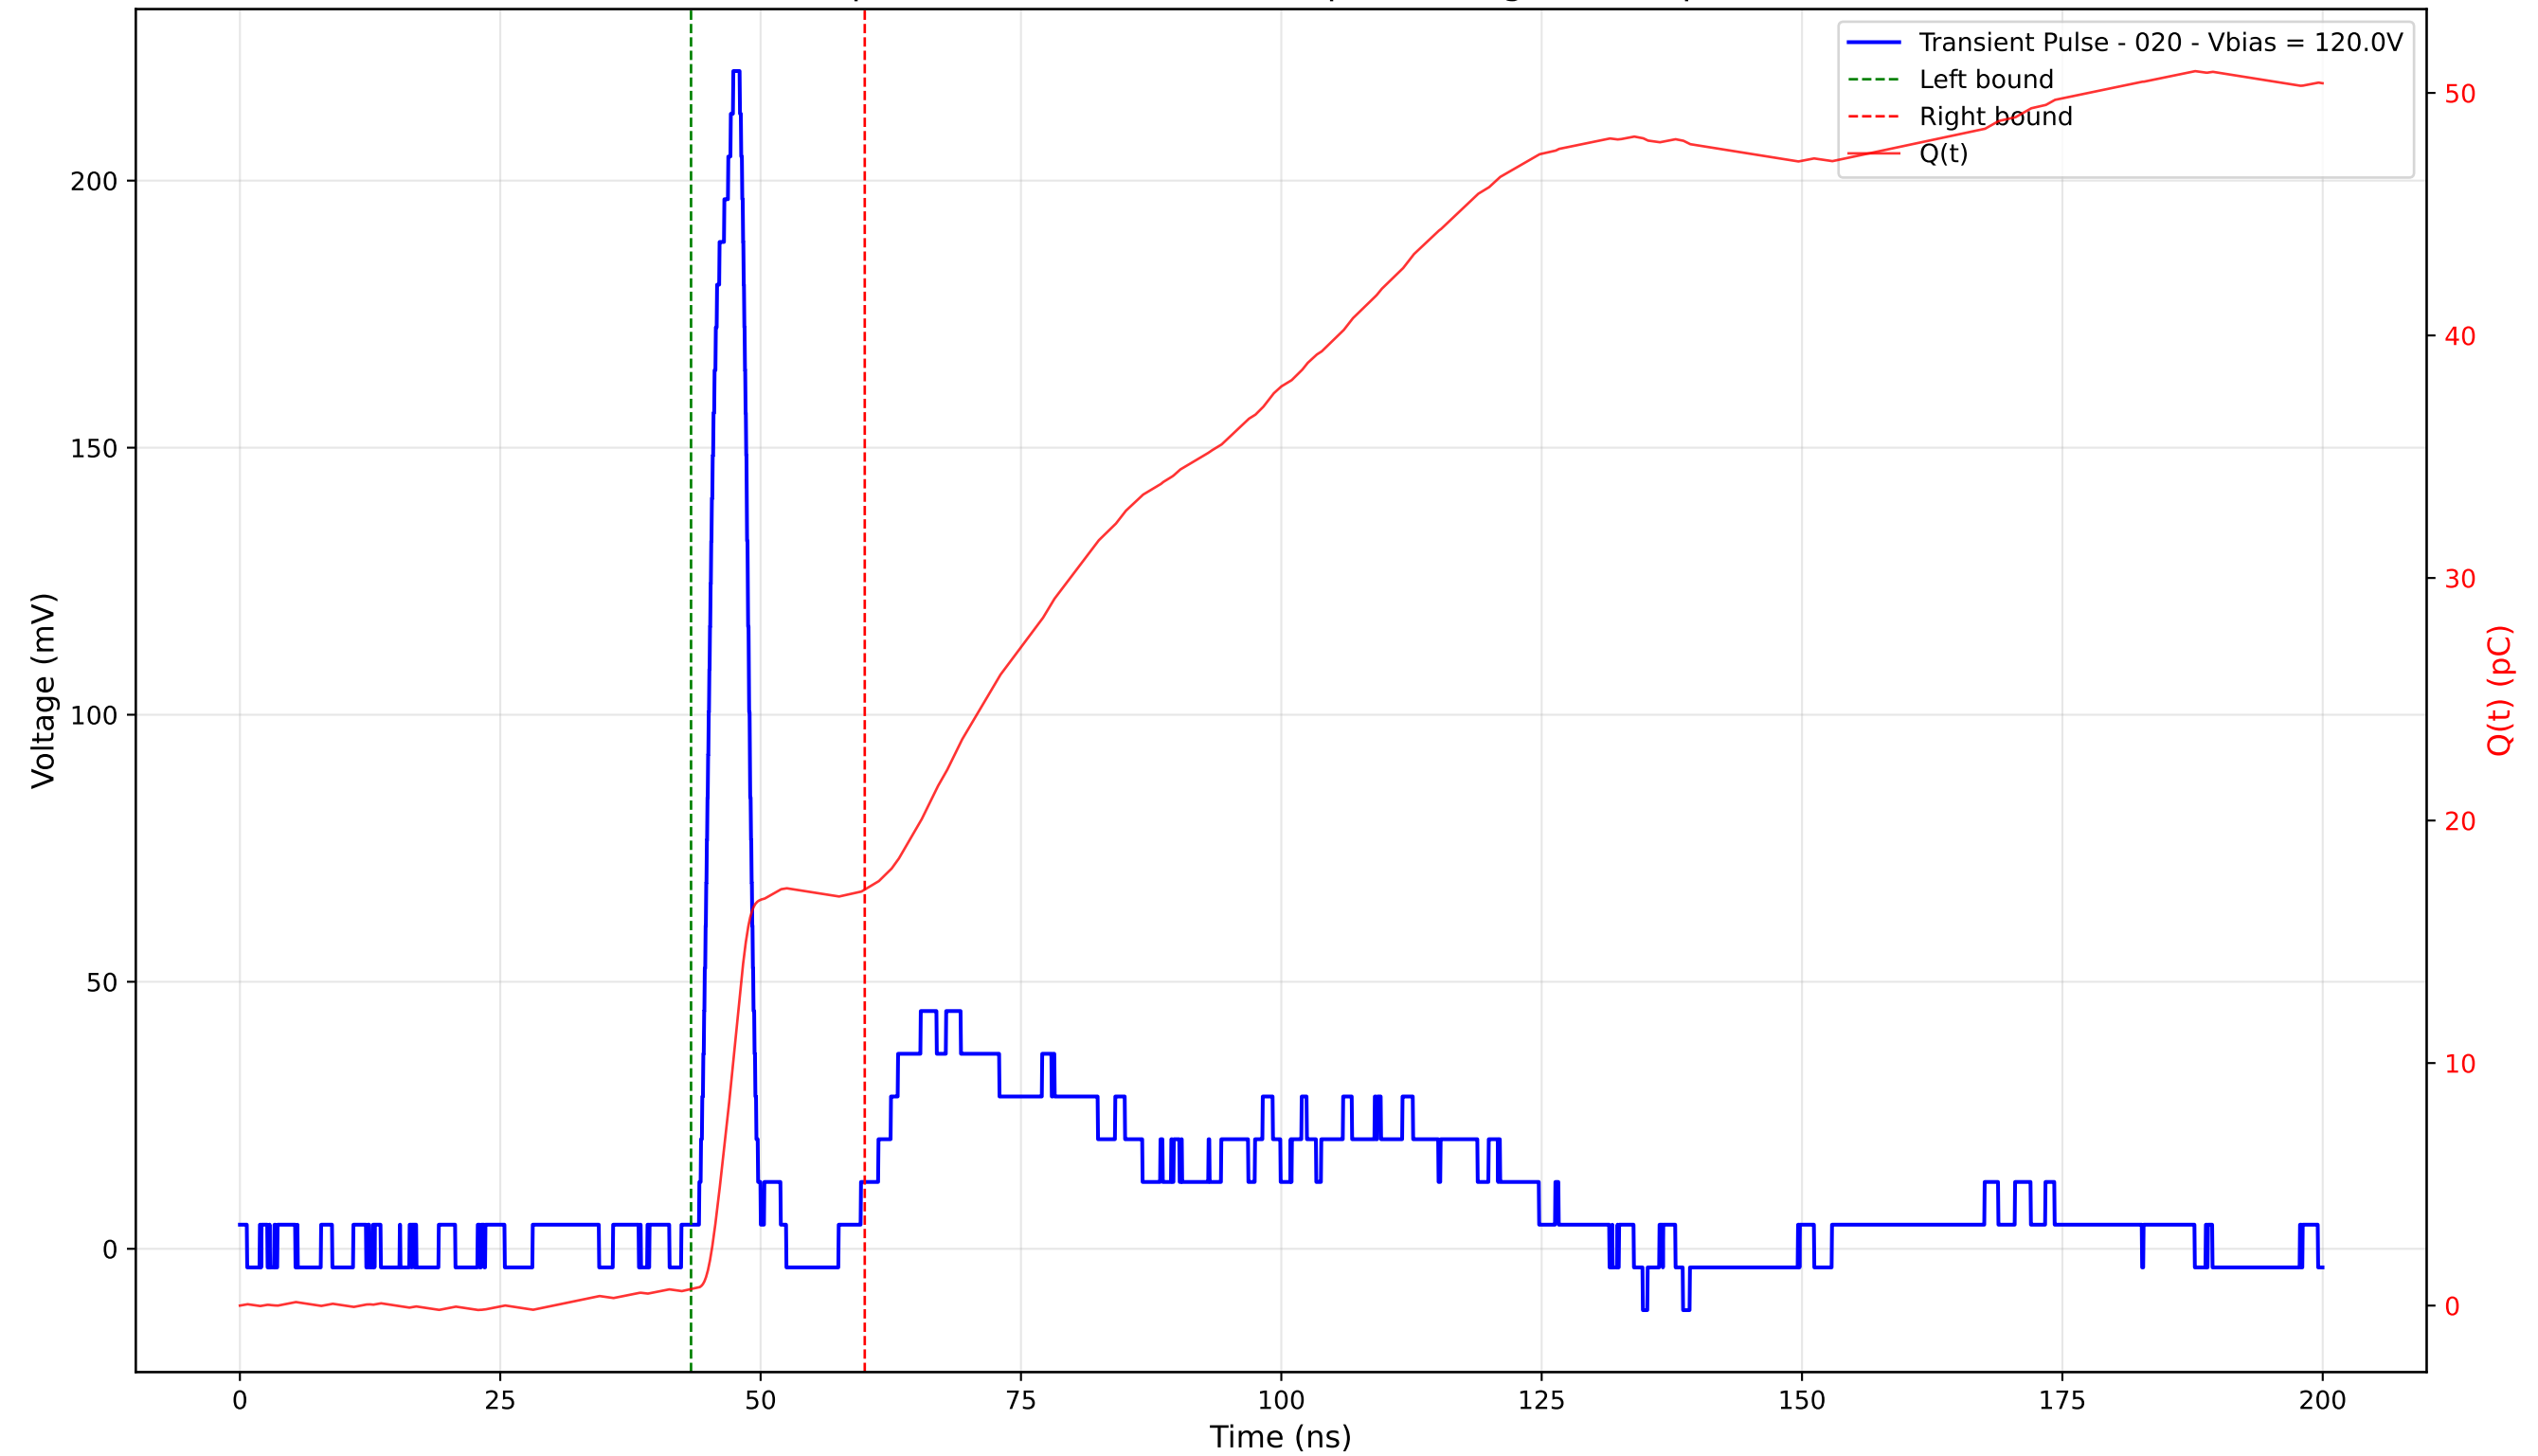


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 15.71 pC - Rise Time: 2.68 ns

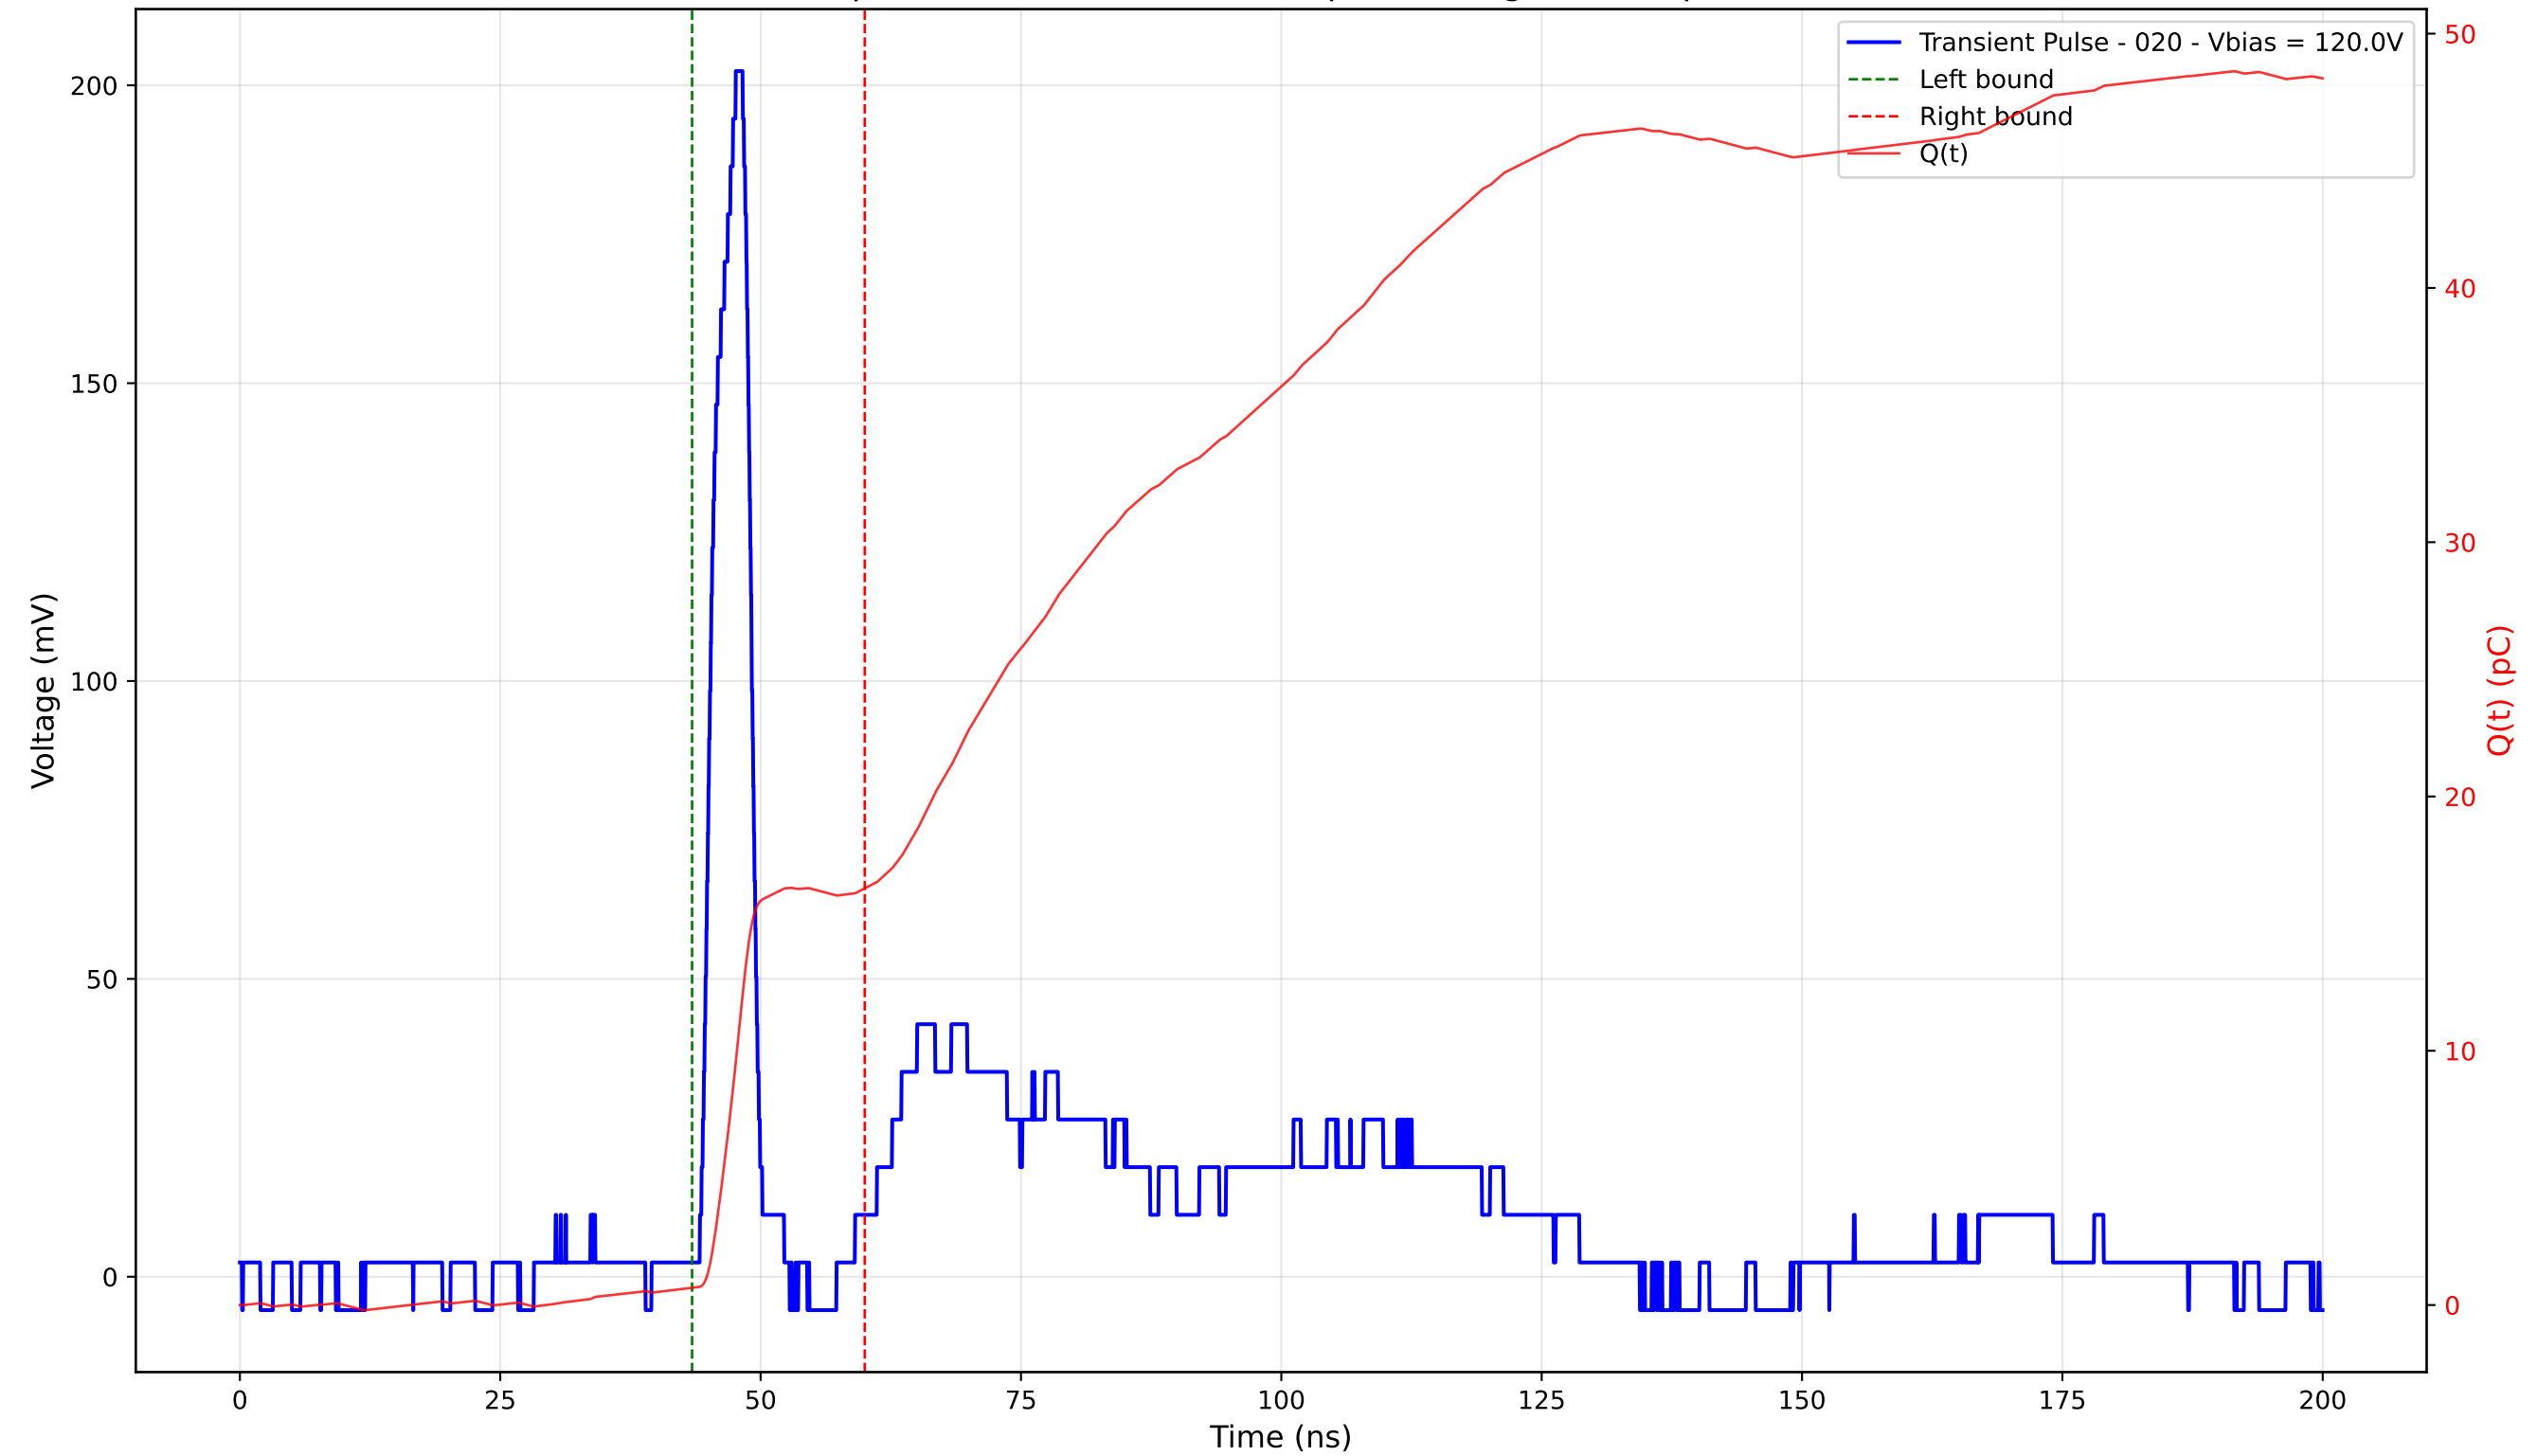


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 14.34 pC - Rise Time: 3.12 ns

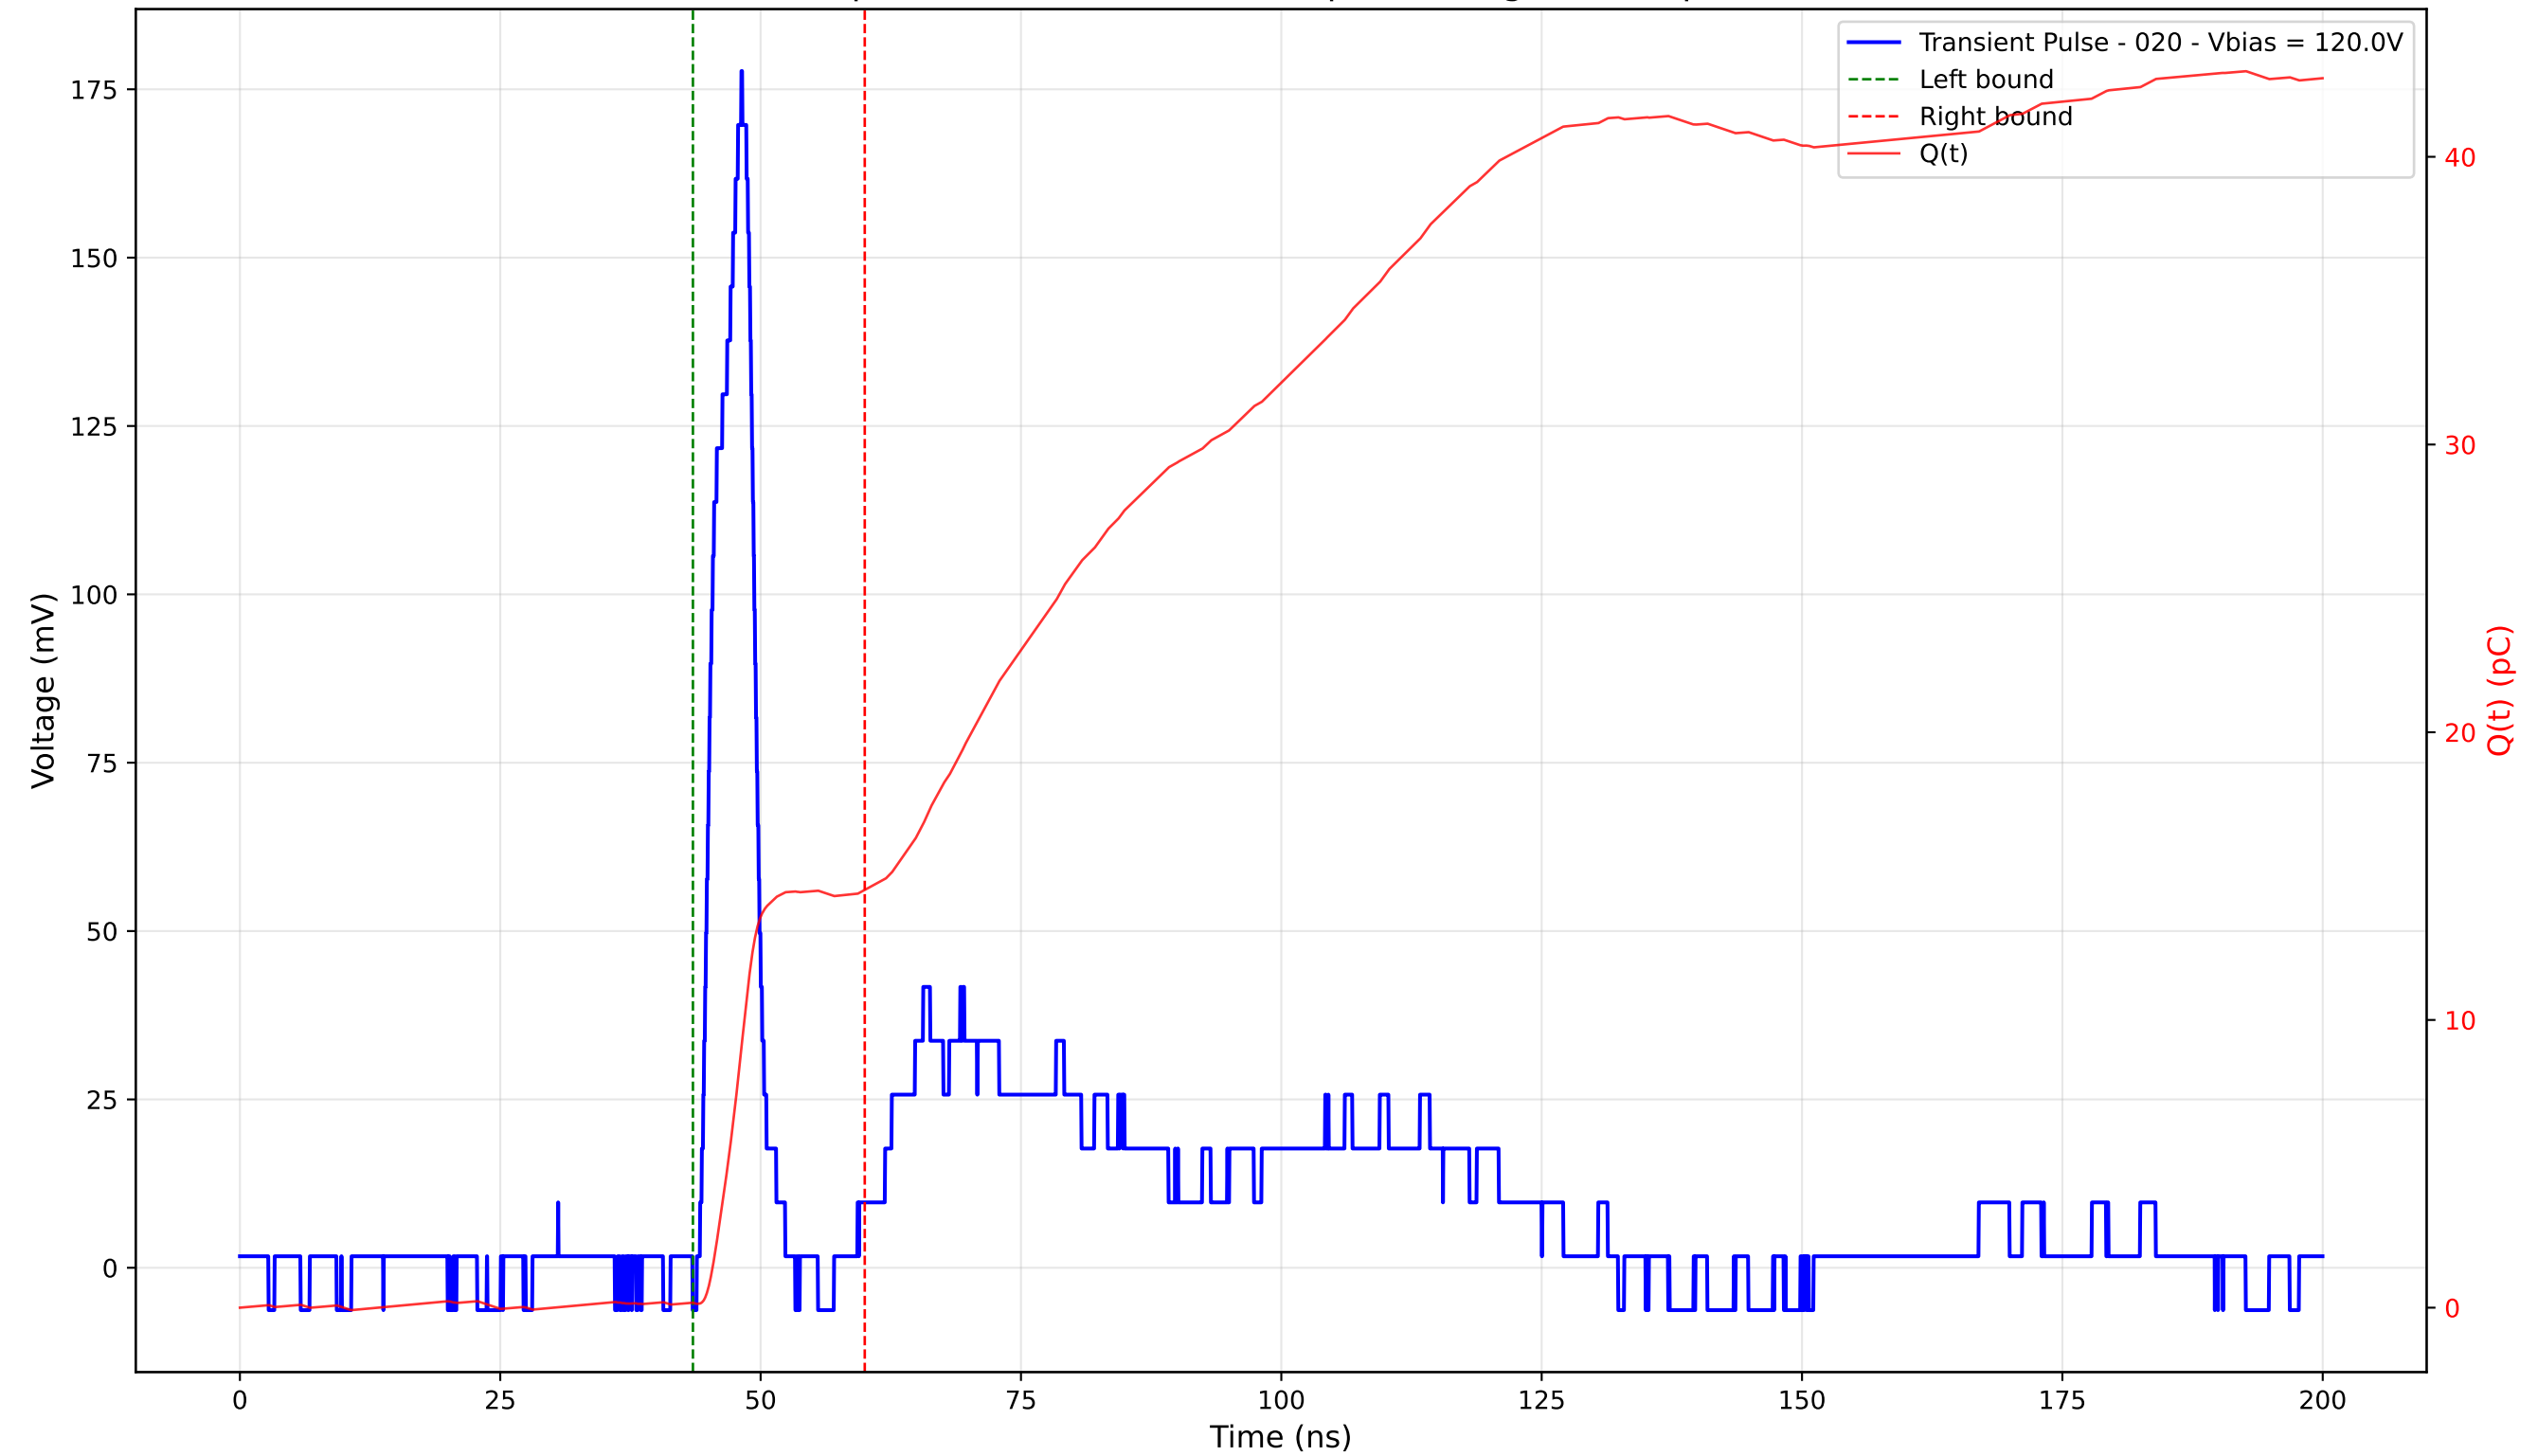


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 13.52 pC - Rise Time: 3.43 ns

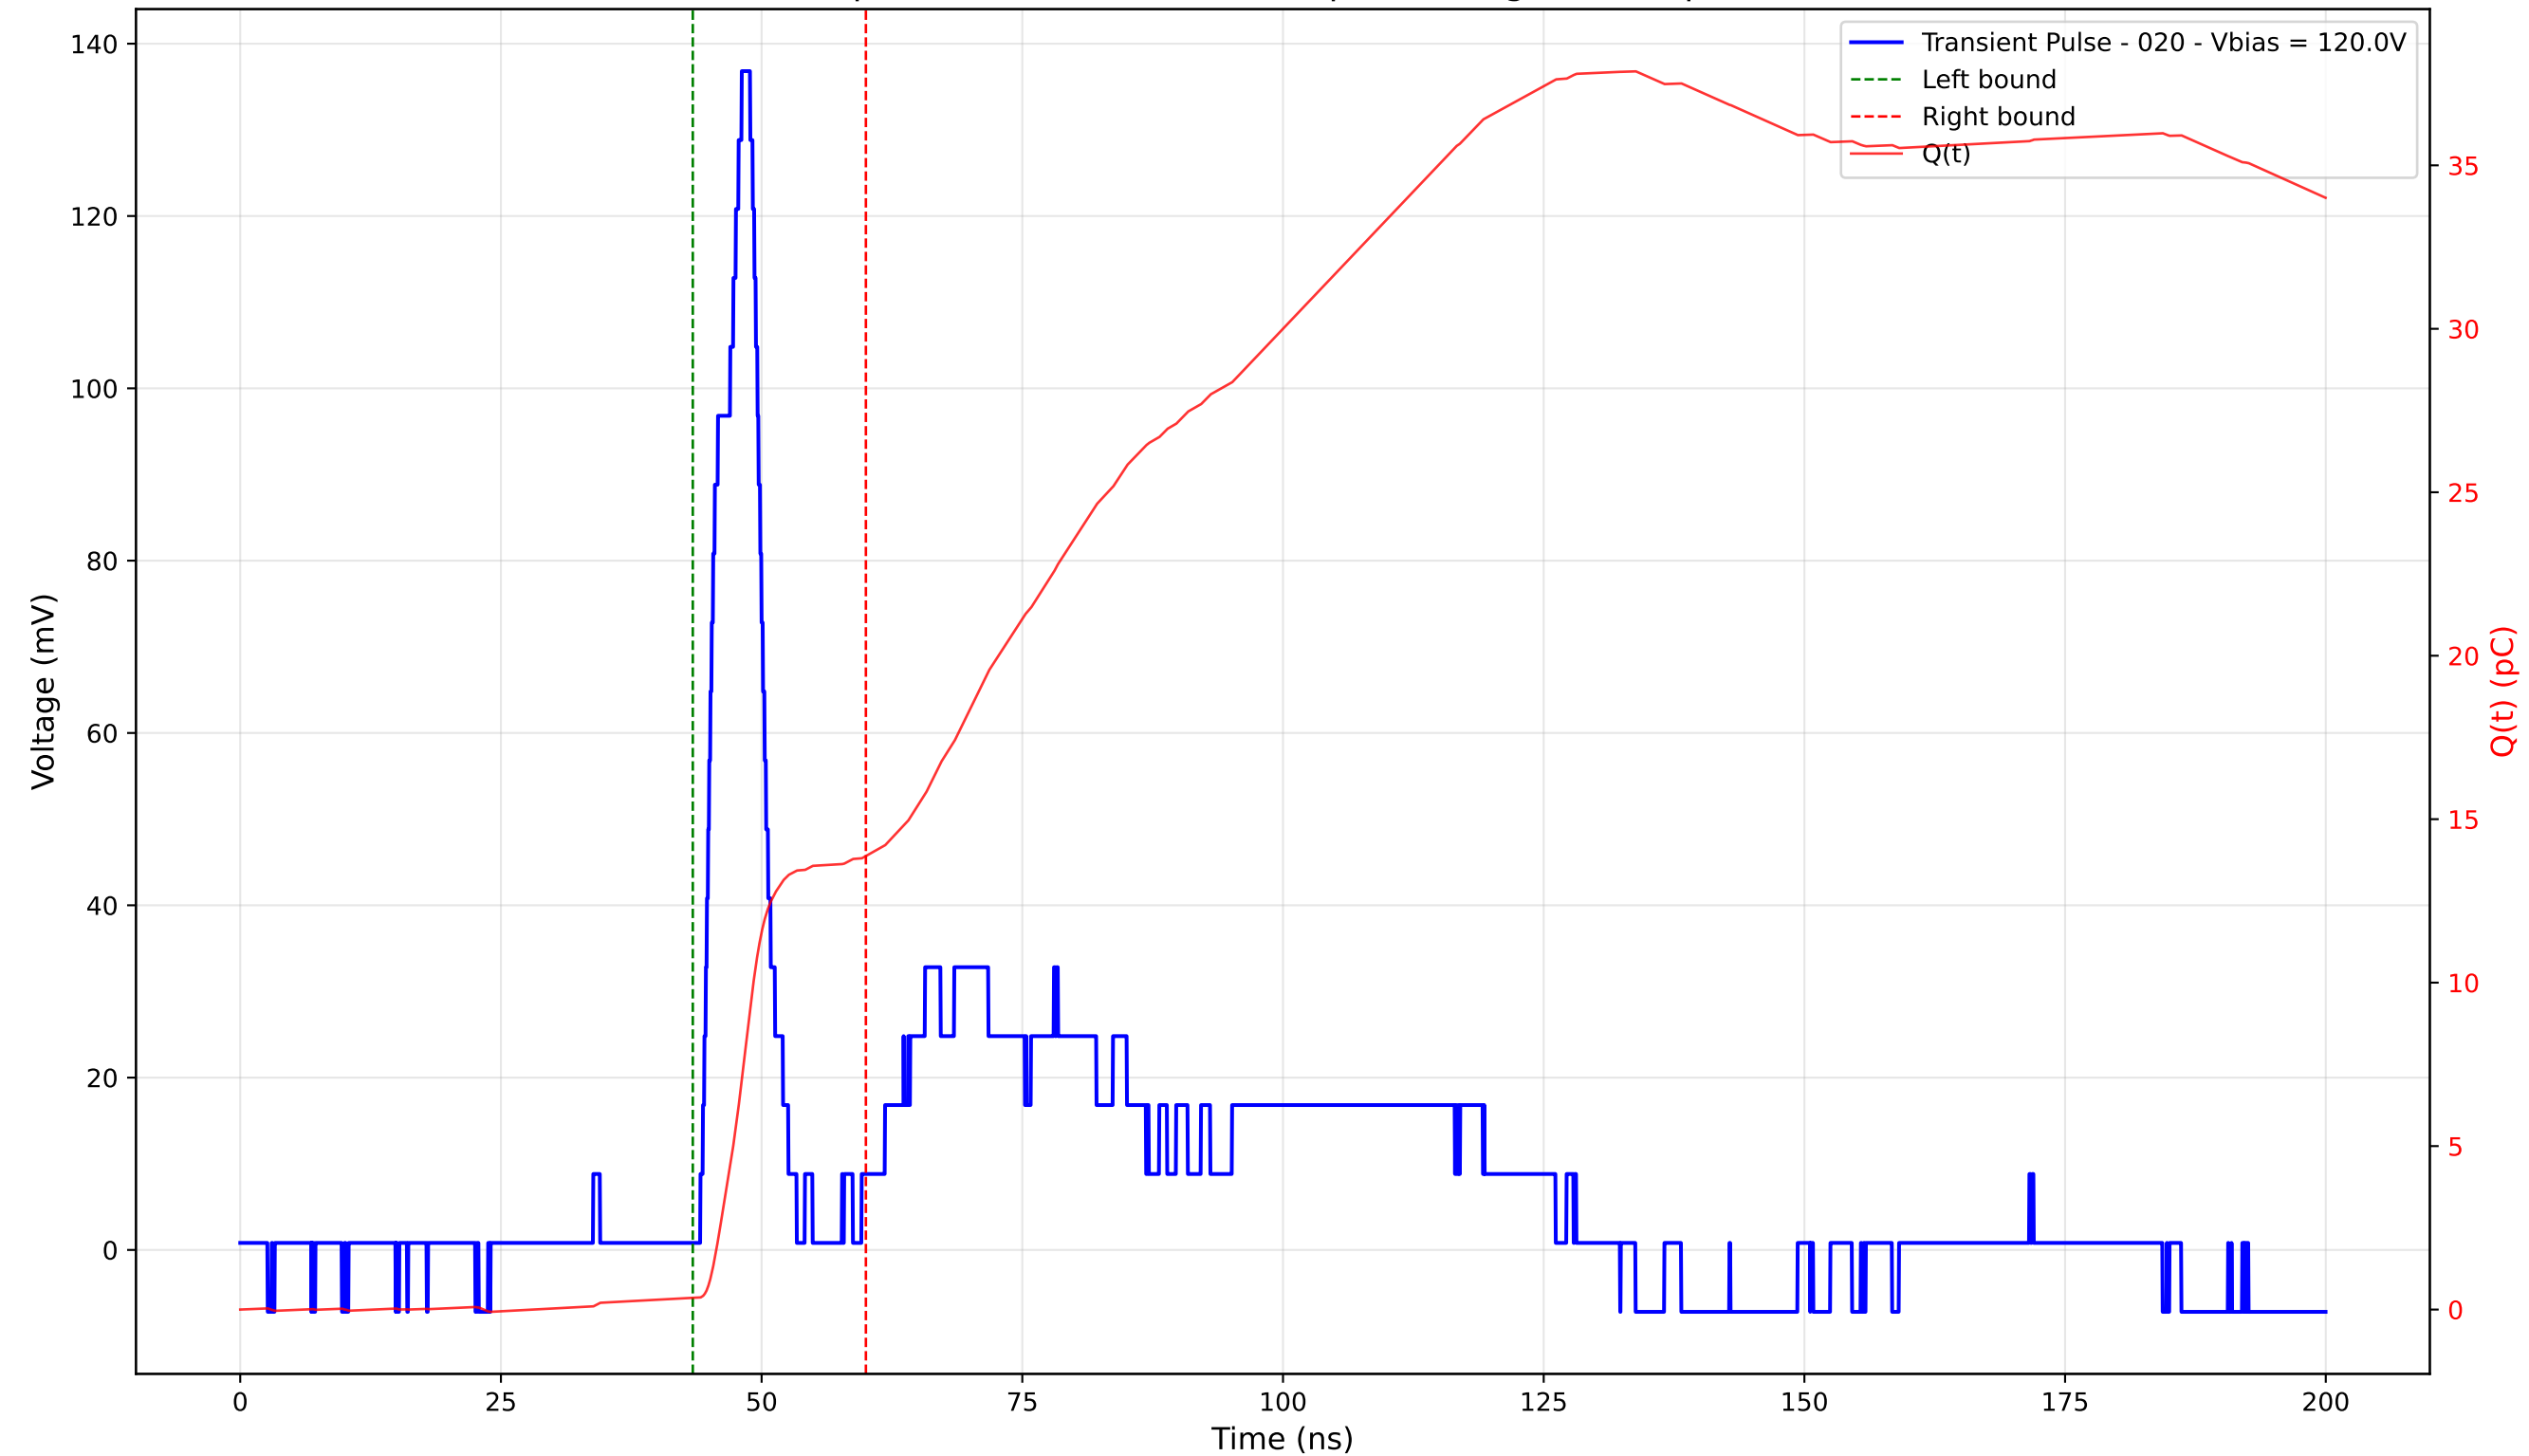


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 12.14 pC - Rise Time: 3.62 ns

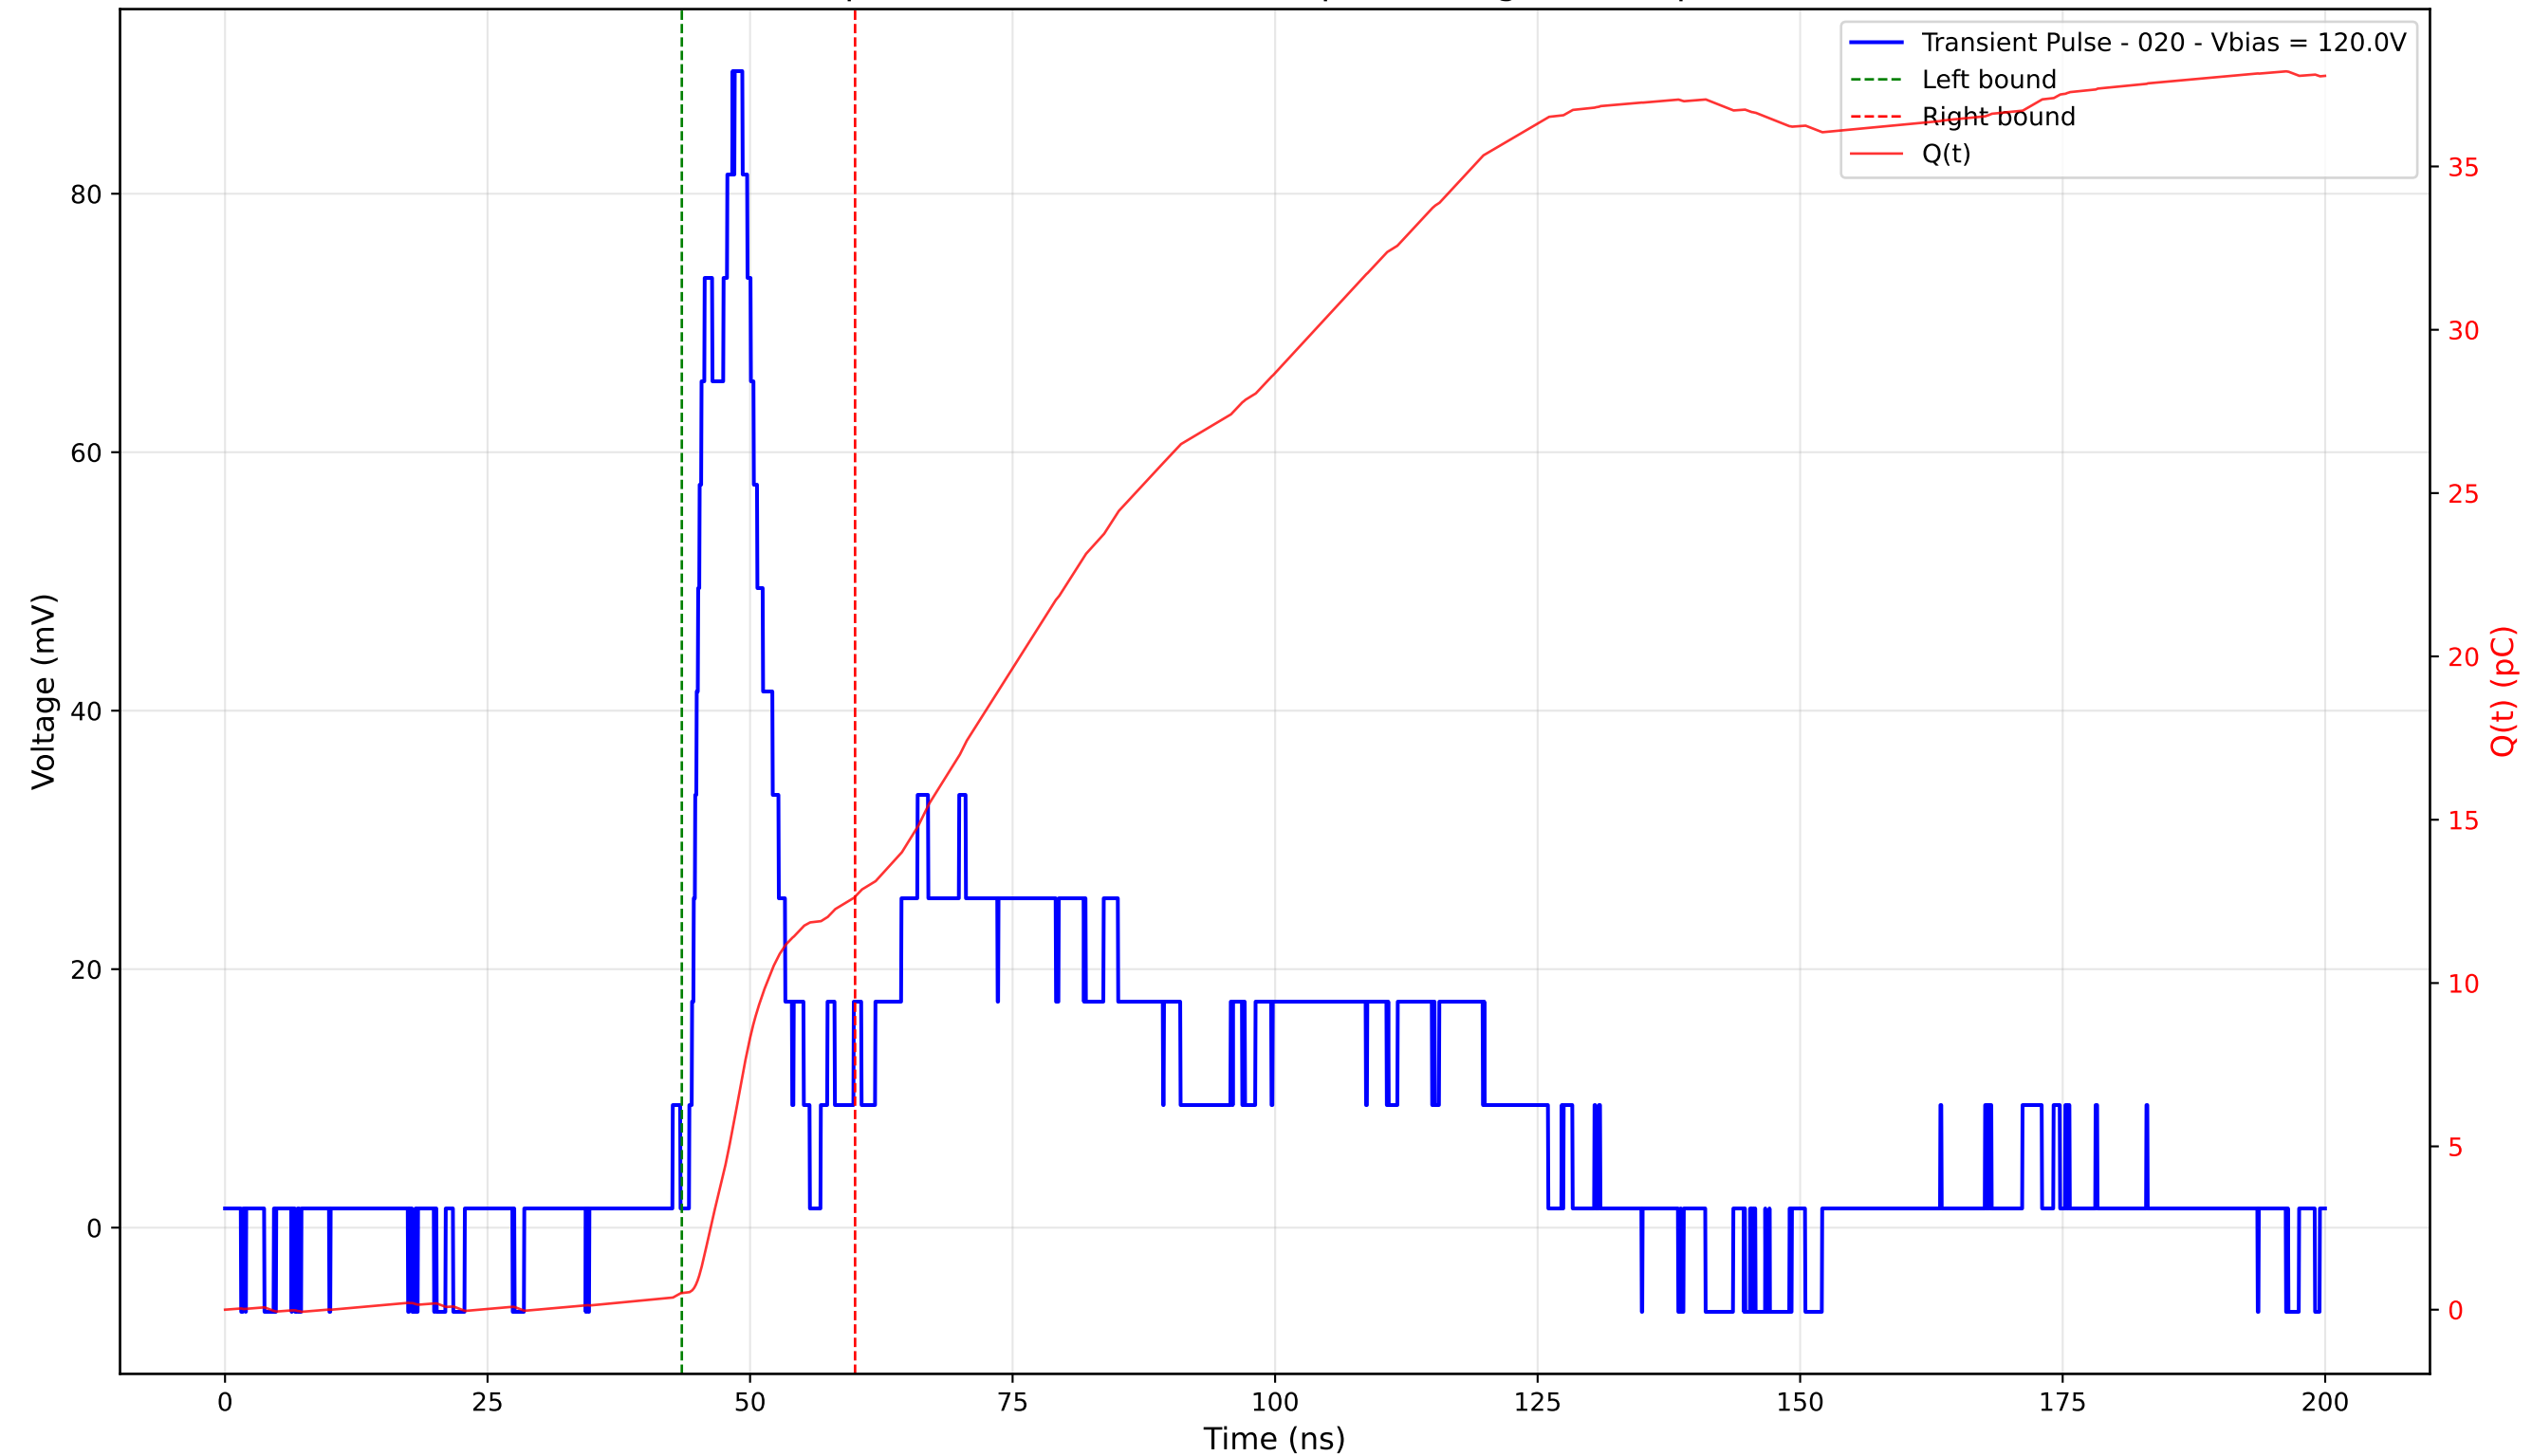


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 9.81 pC - Rise Time: 1.19 ns

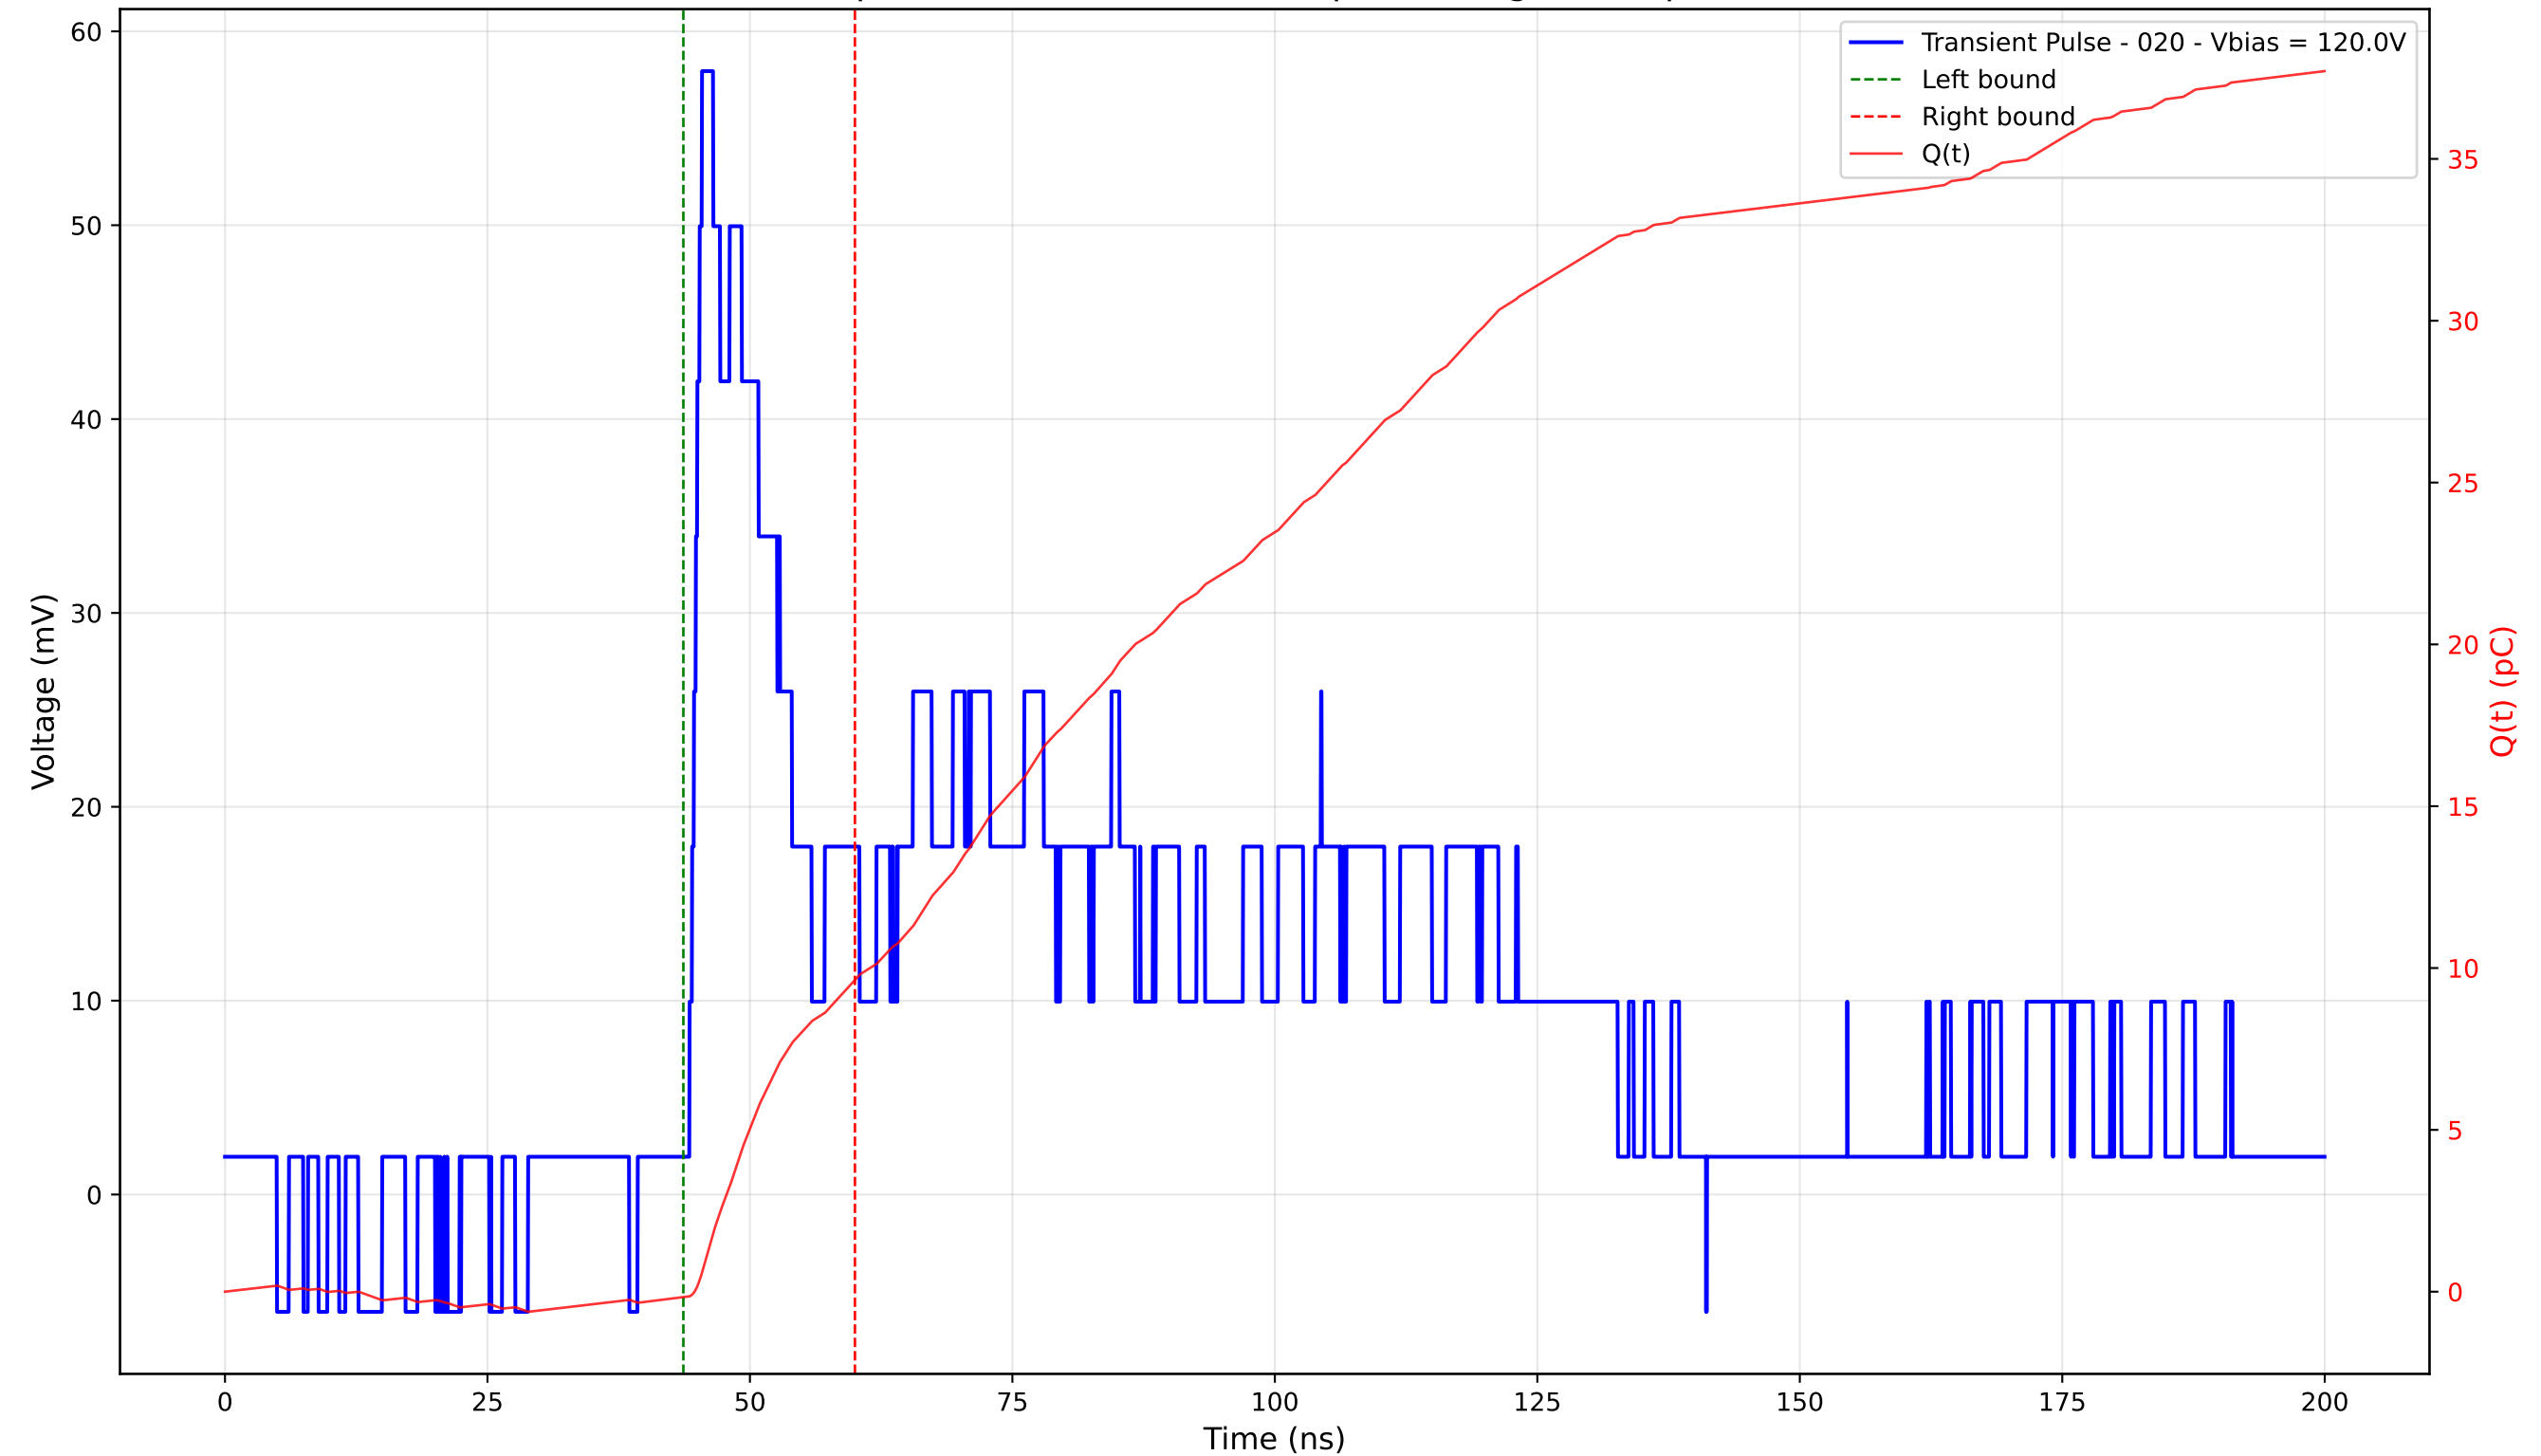


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 7.73 pC - Rise Time: 0.92 ns

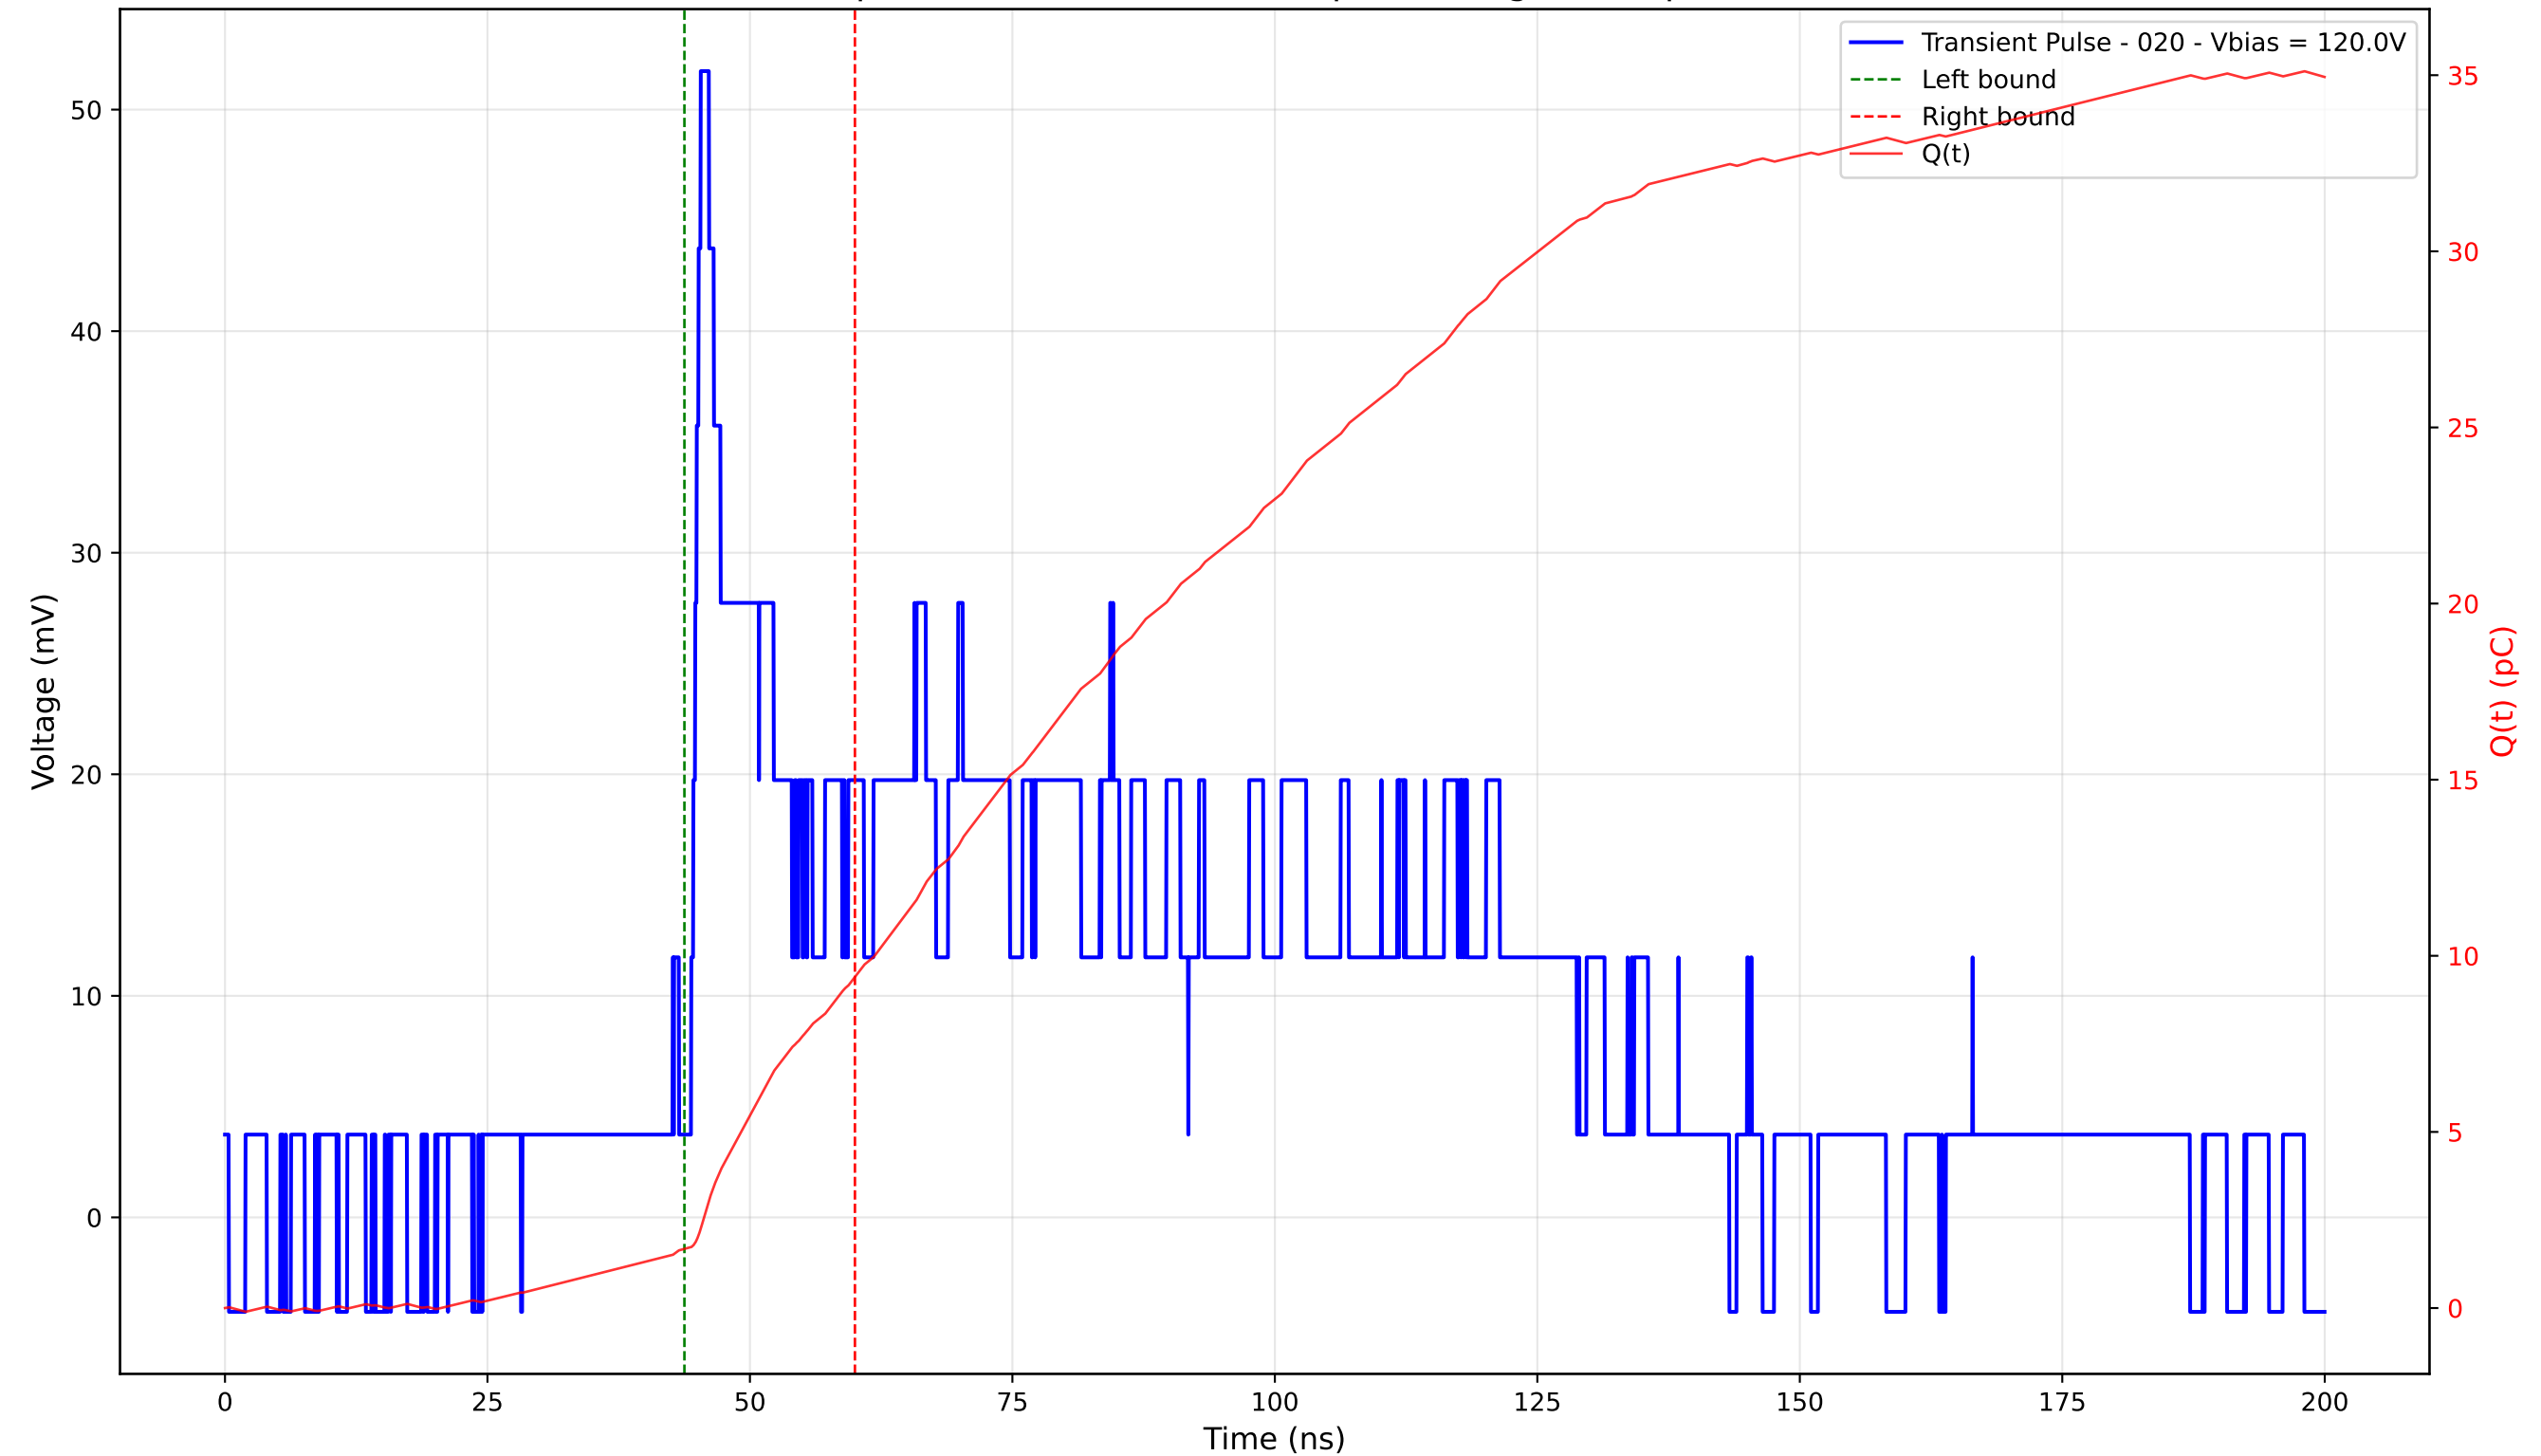


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 5.45 pC - Rise Time: 1.03 ns

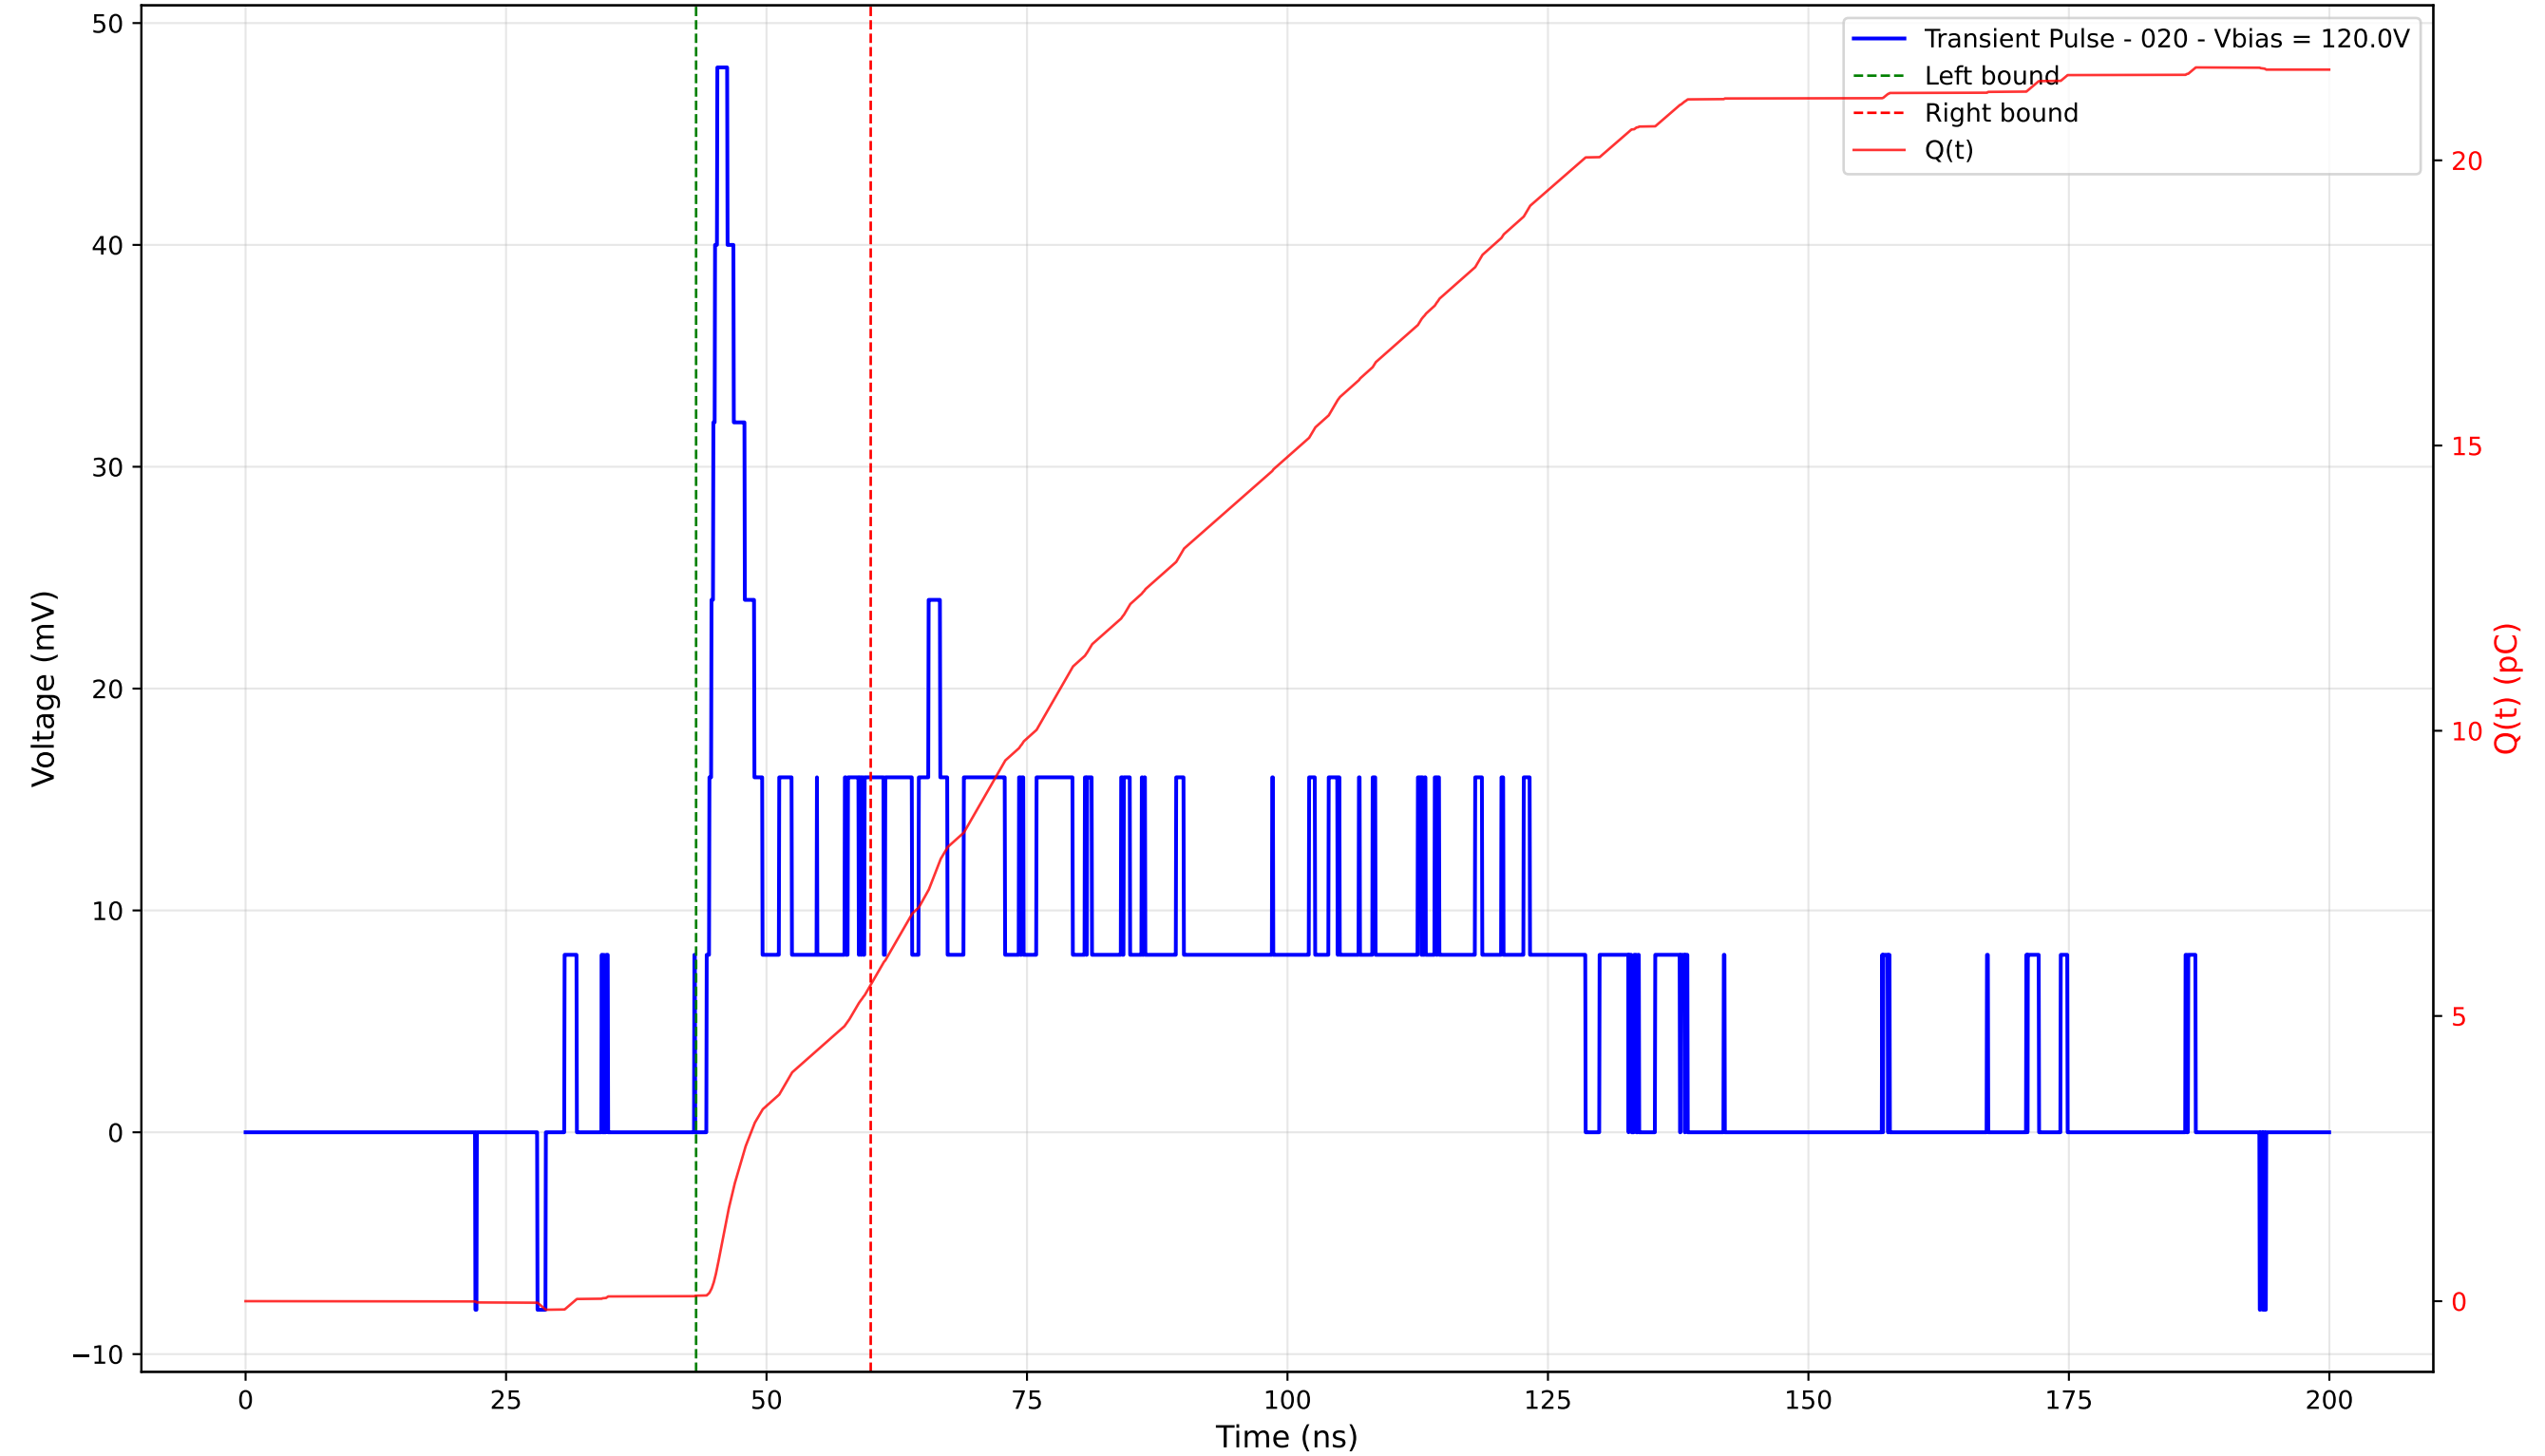


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 5.18 pC - Rise Time: 1.05 ns

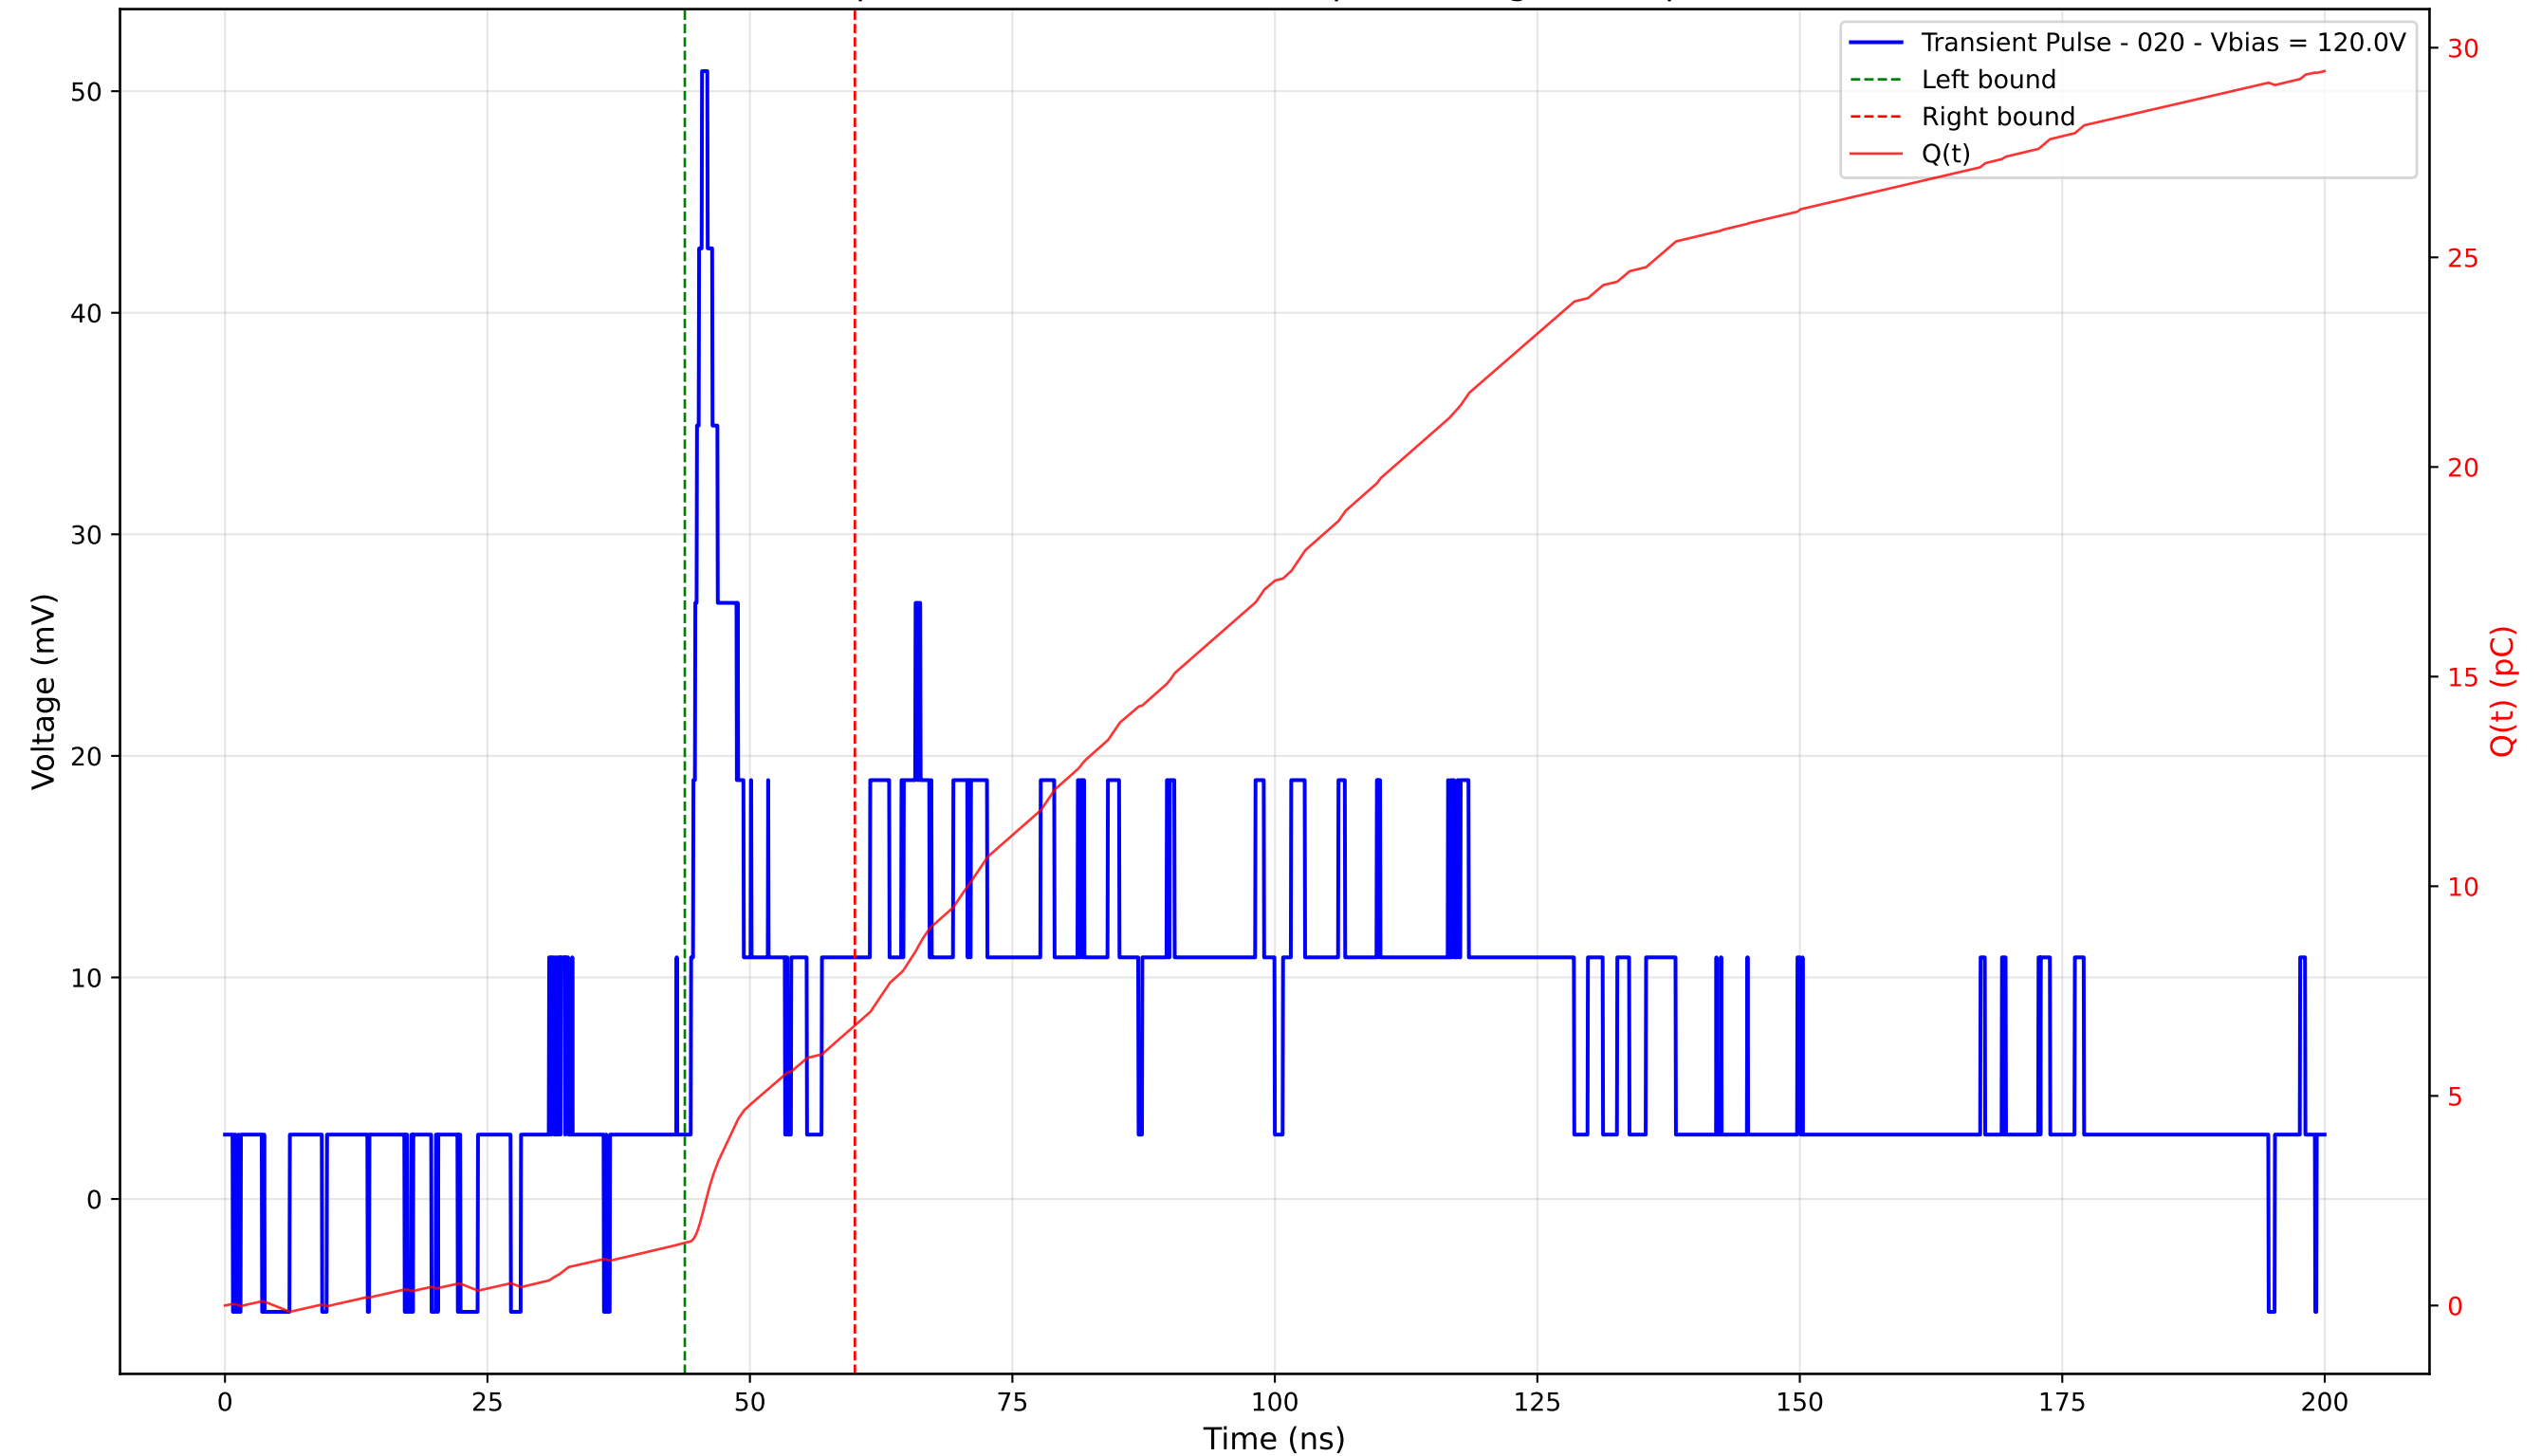


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 4.15 pC - Rise Time: 0.92 ns

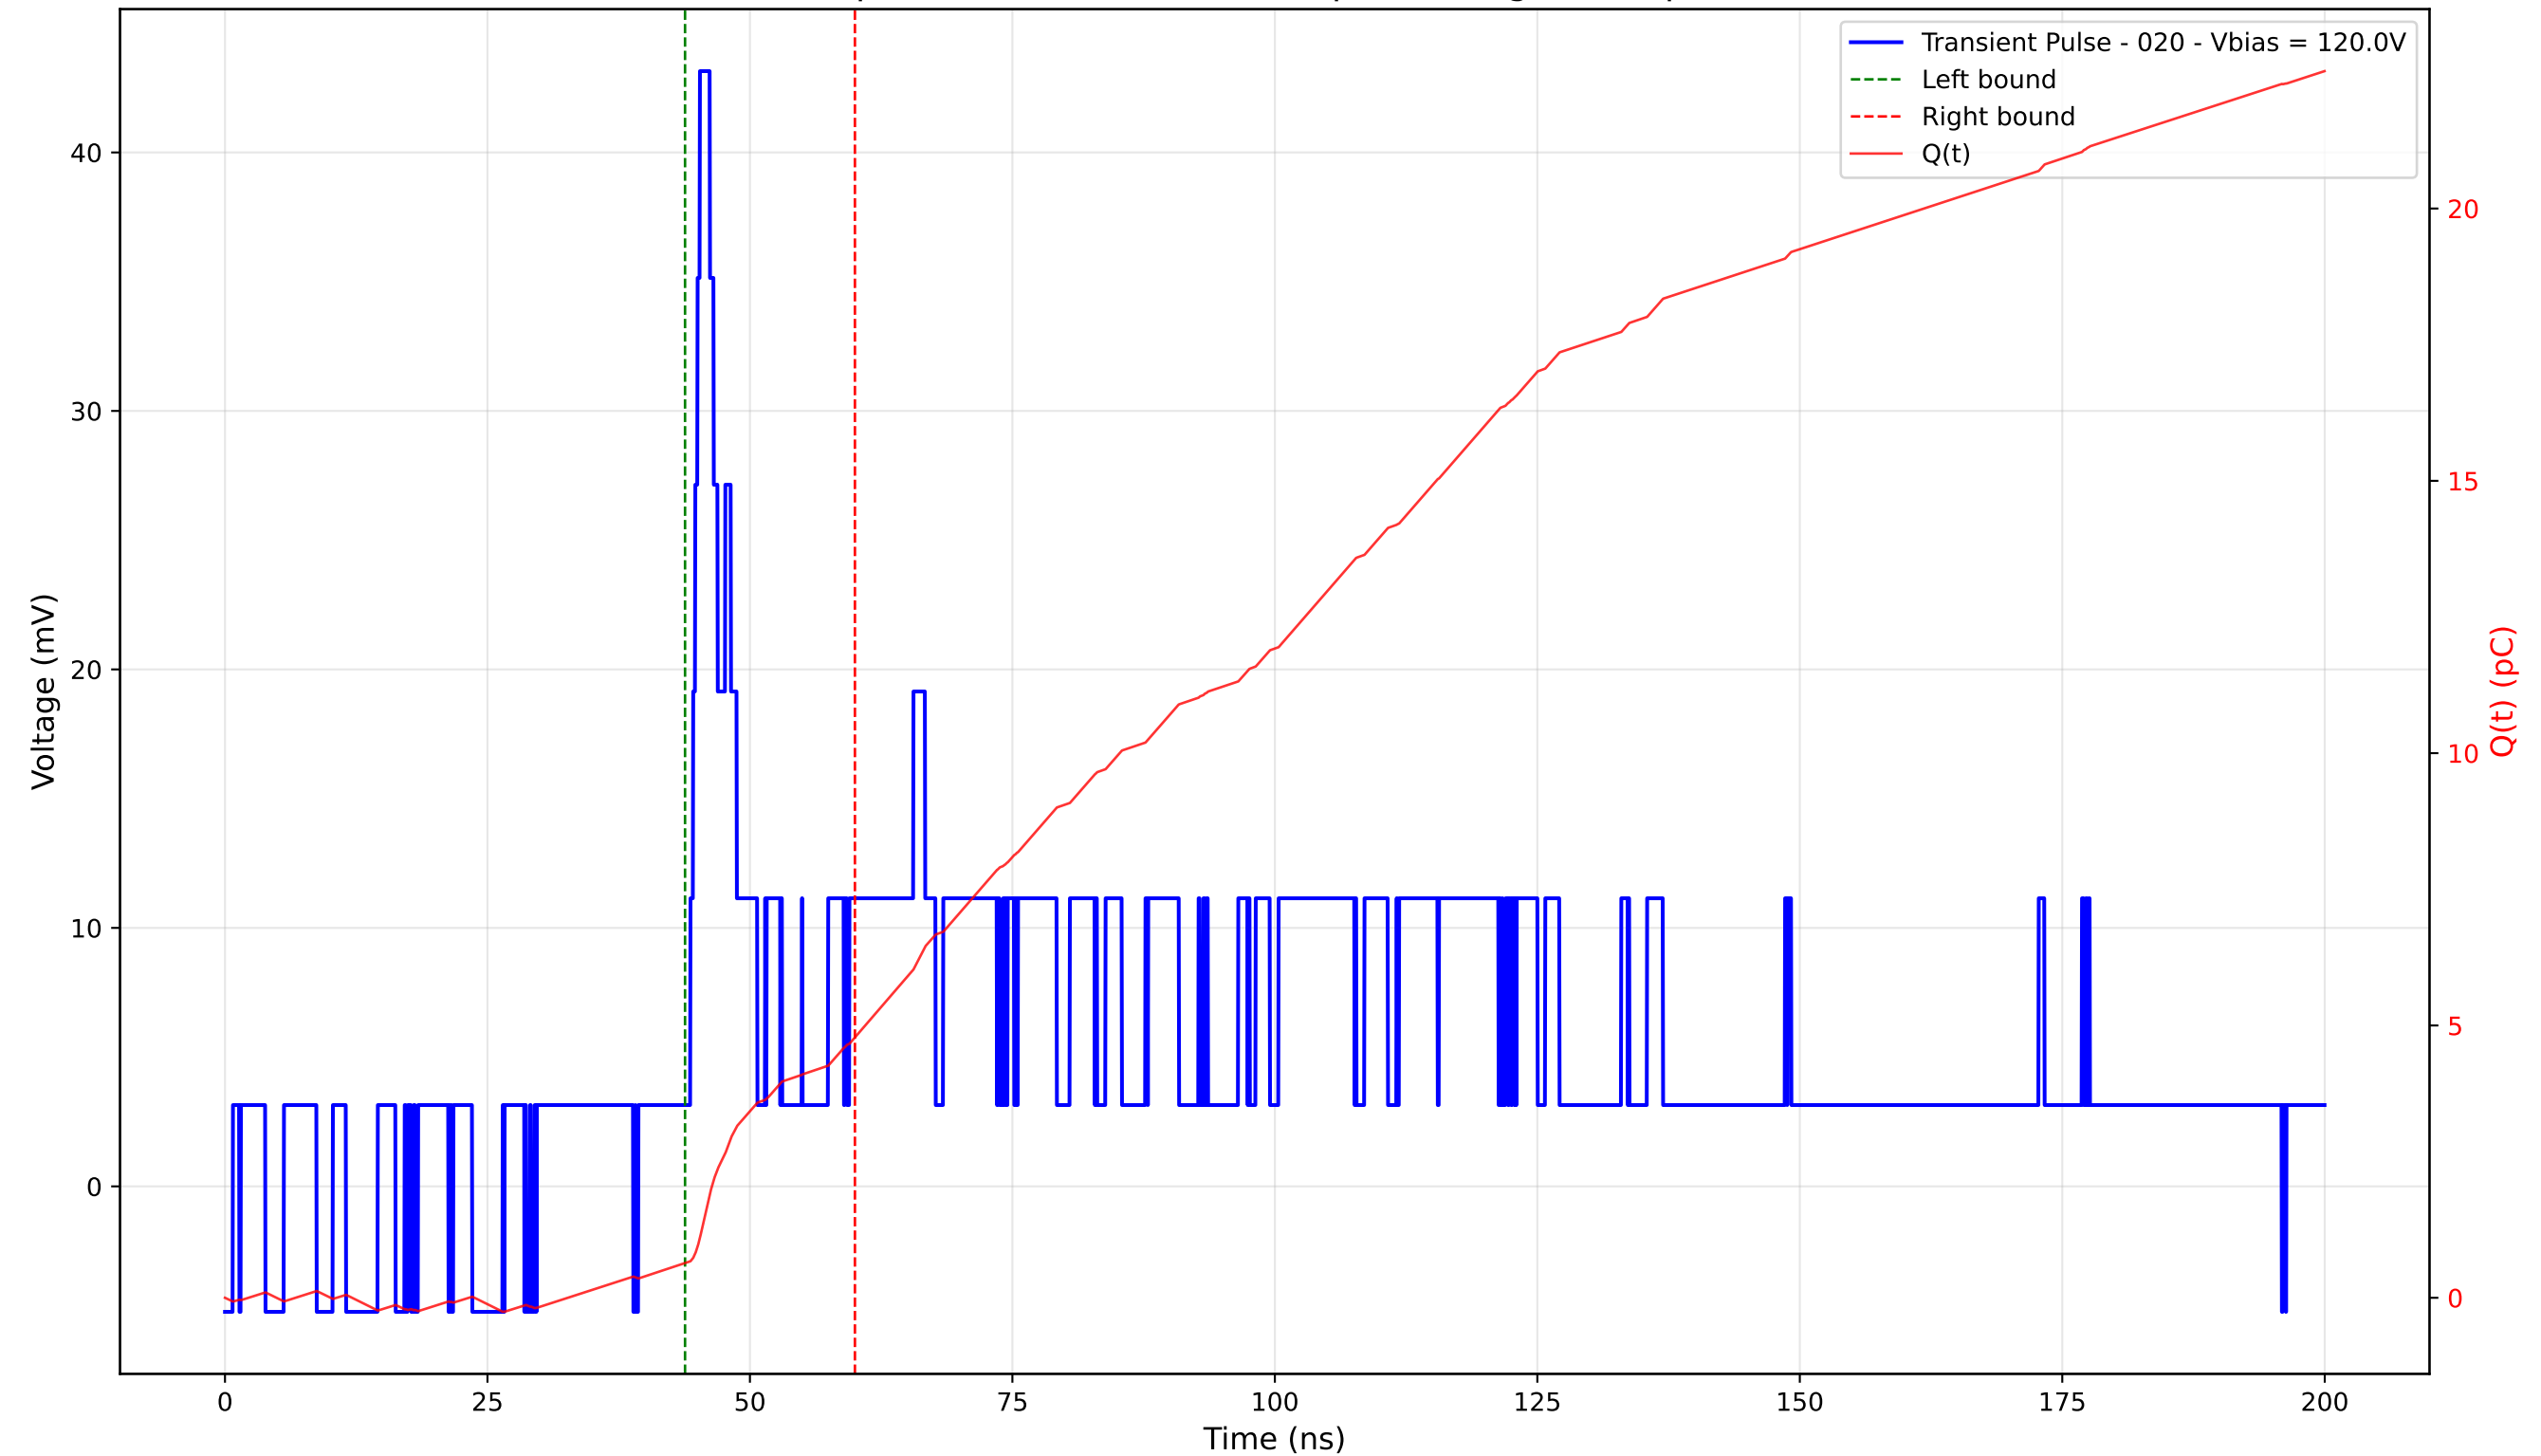


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 3.34 pC - Rise Time: 1.19 ns

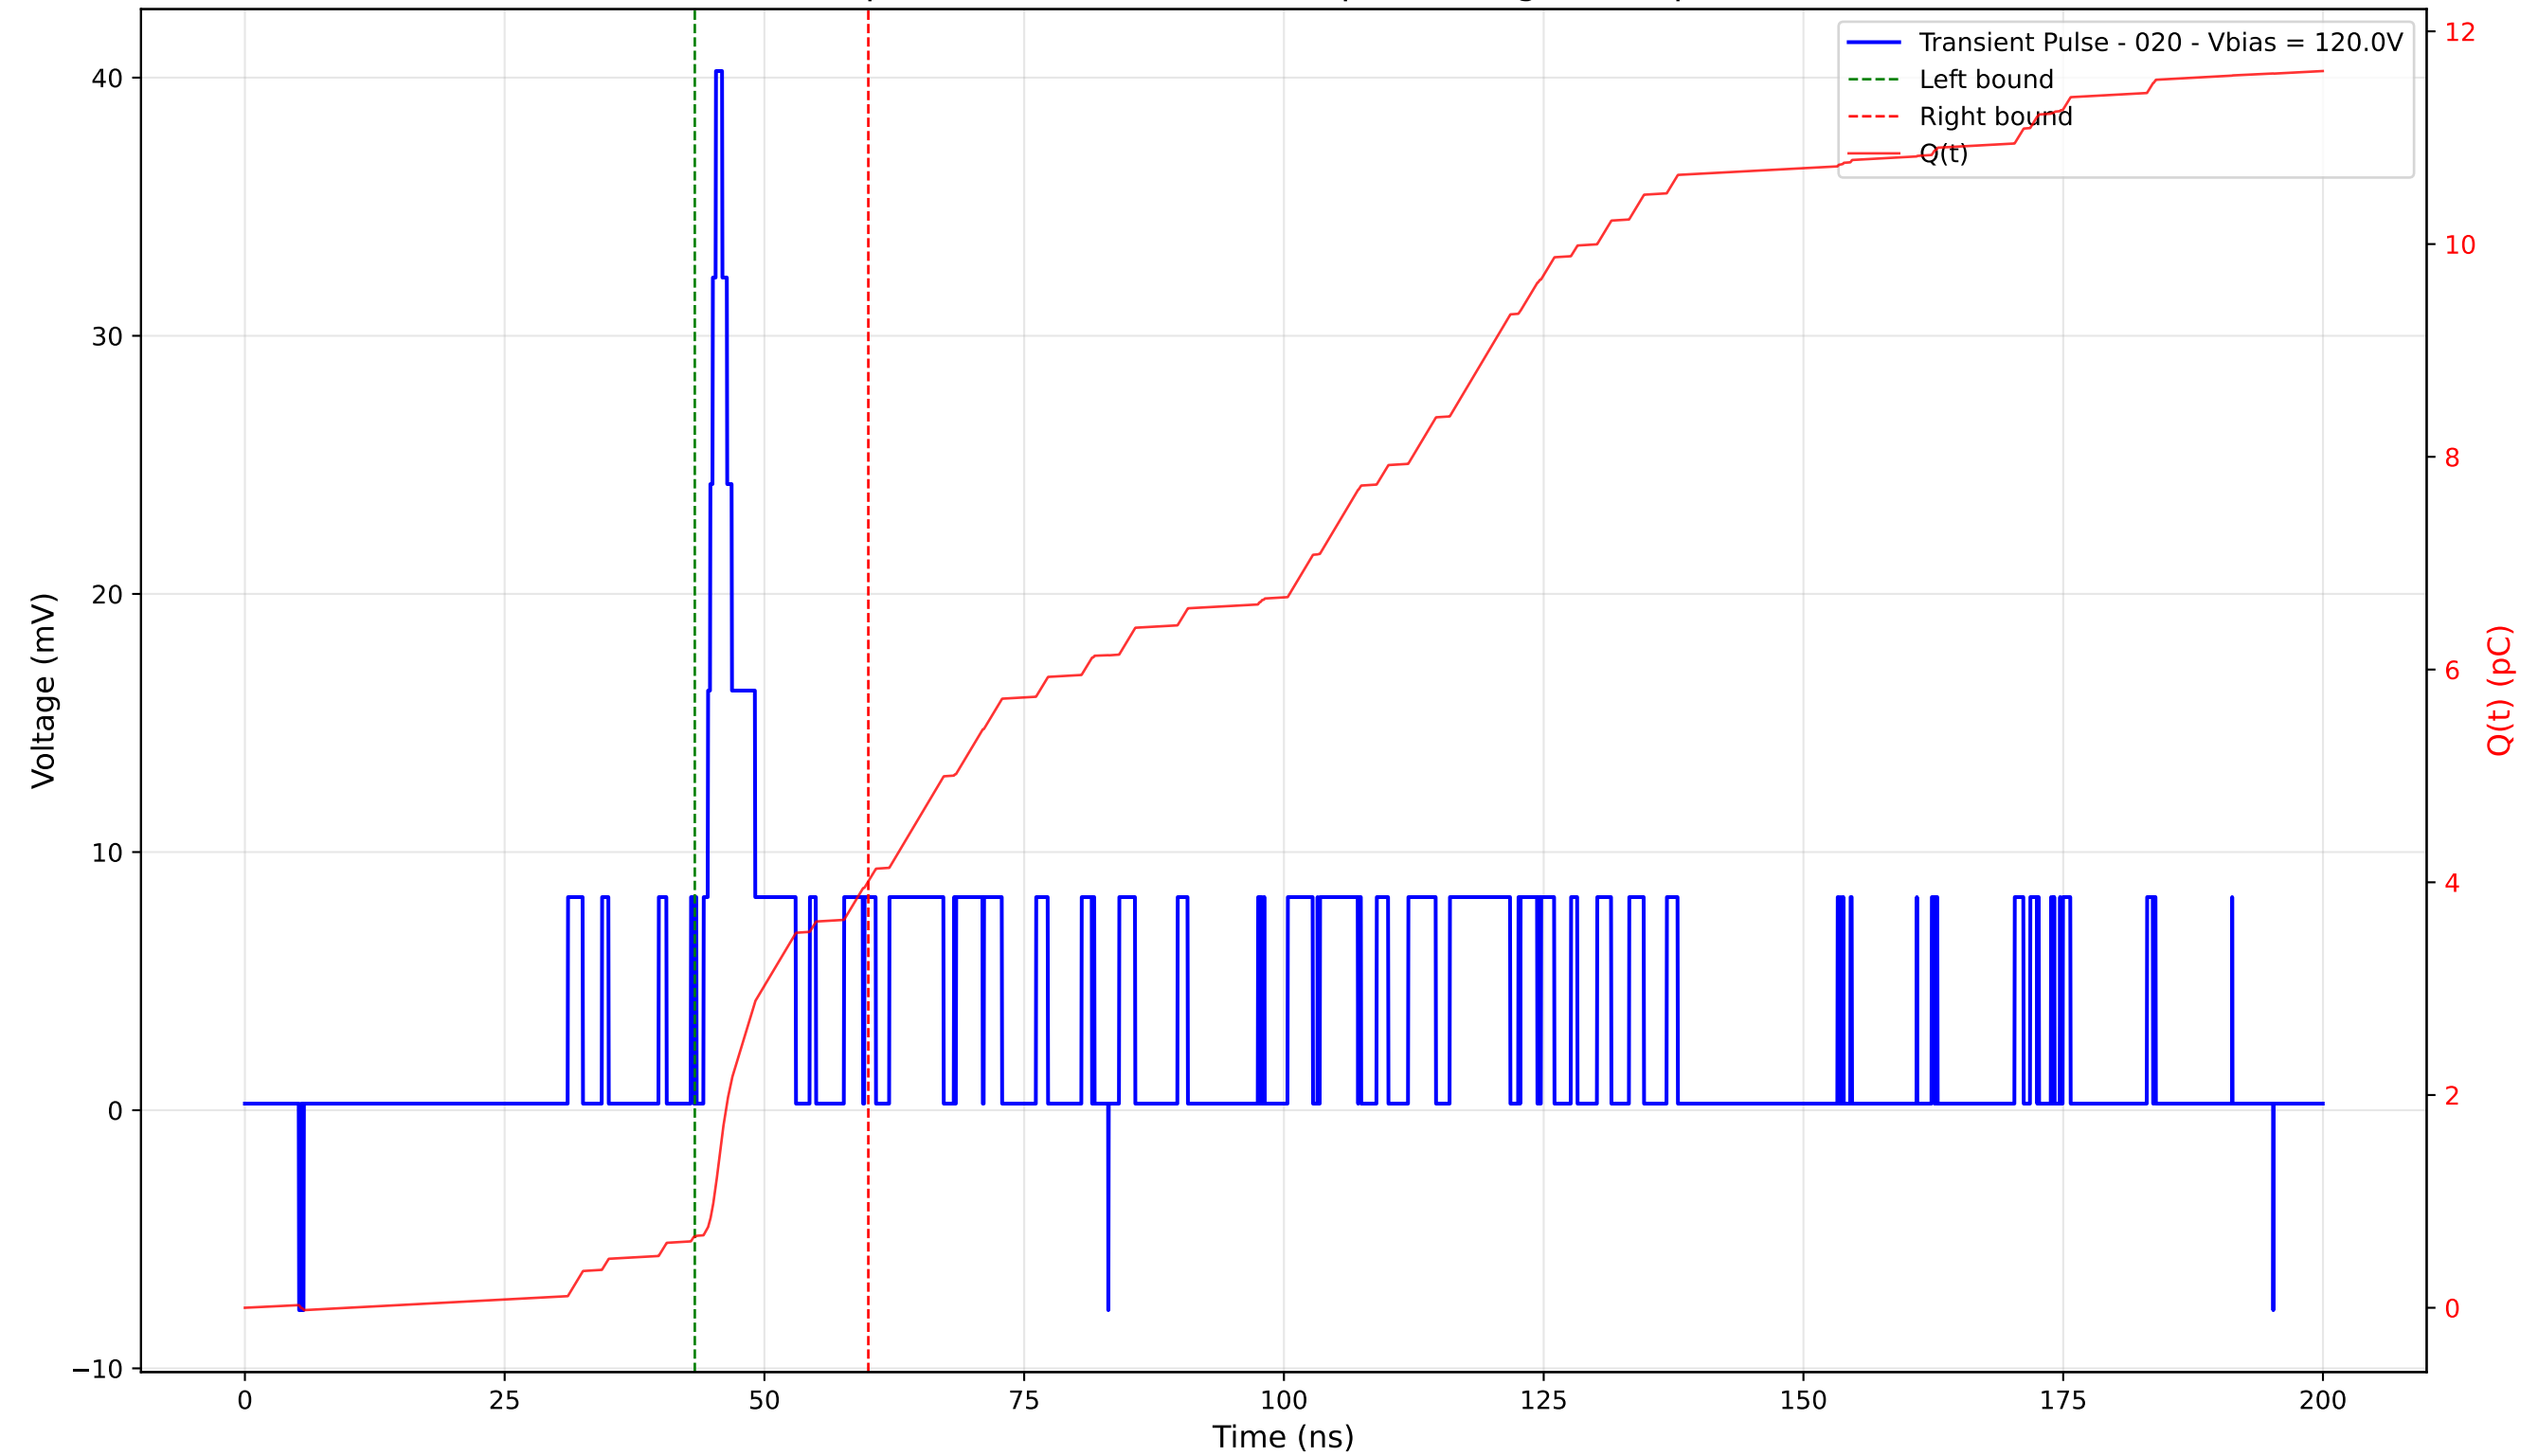


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 3.41 pC - Rise Time: 1.39 ns

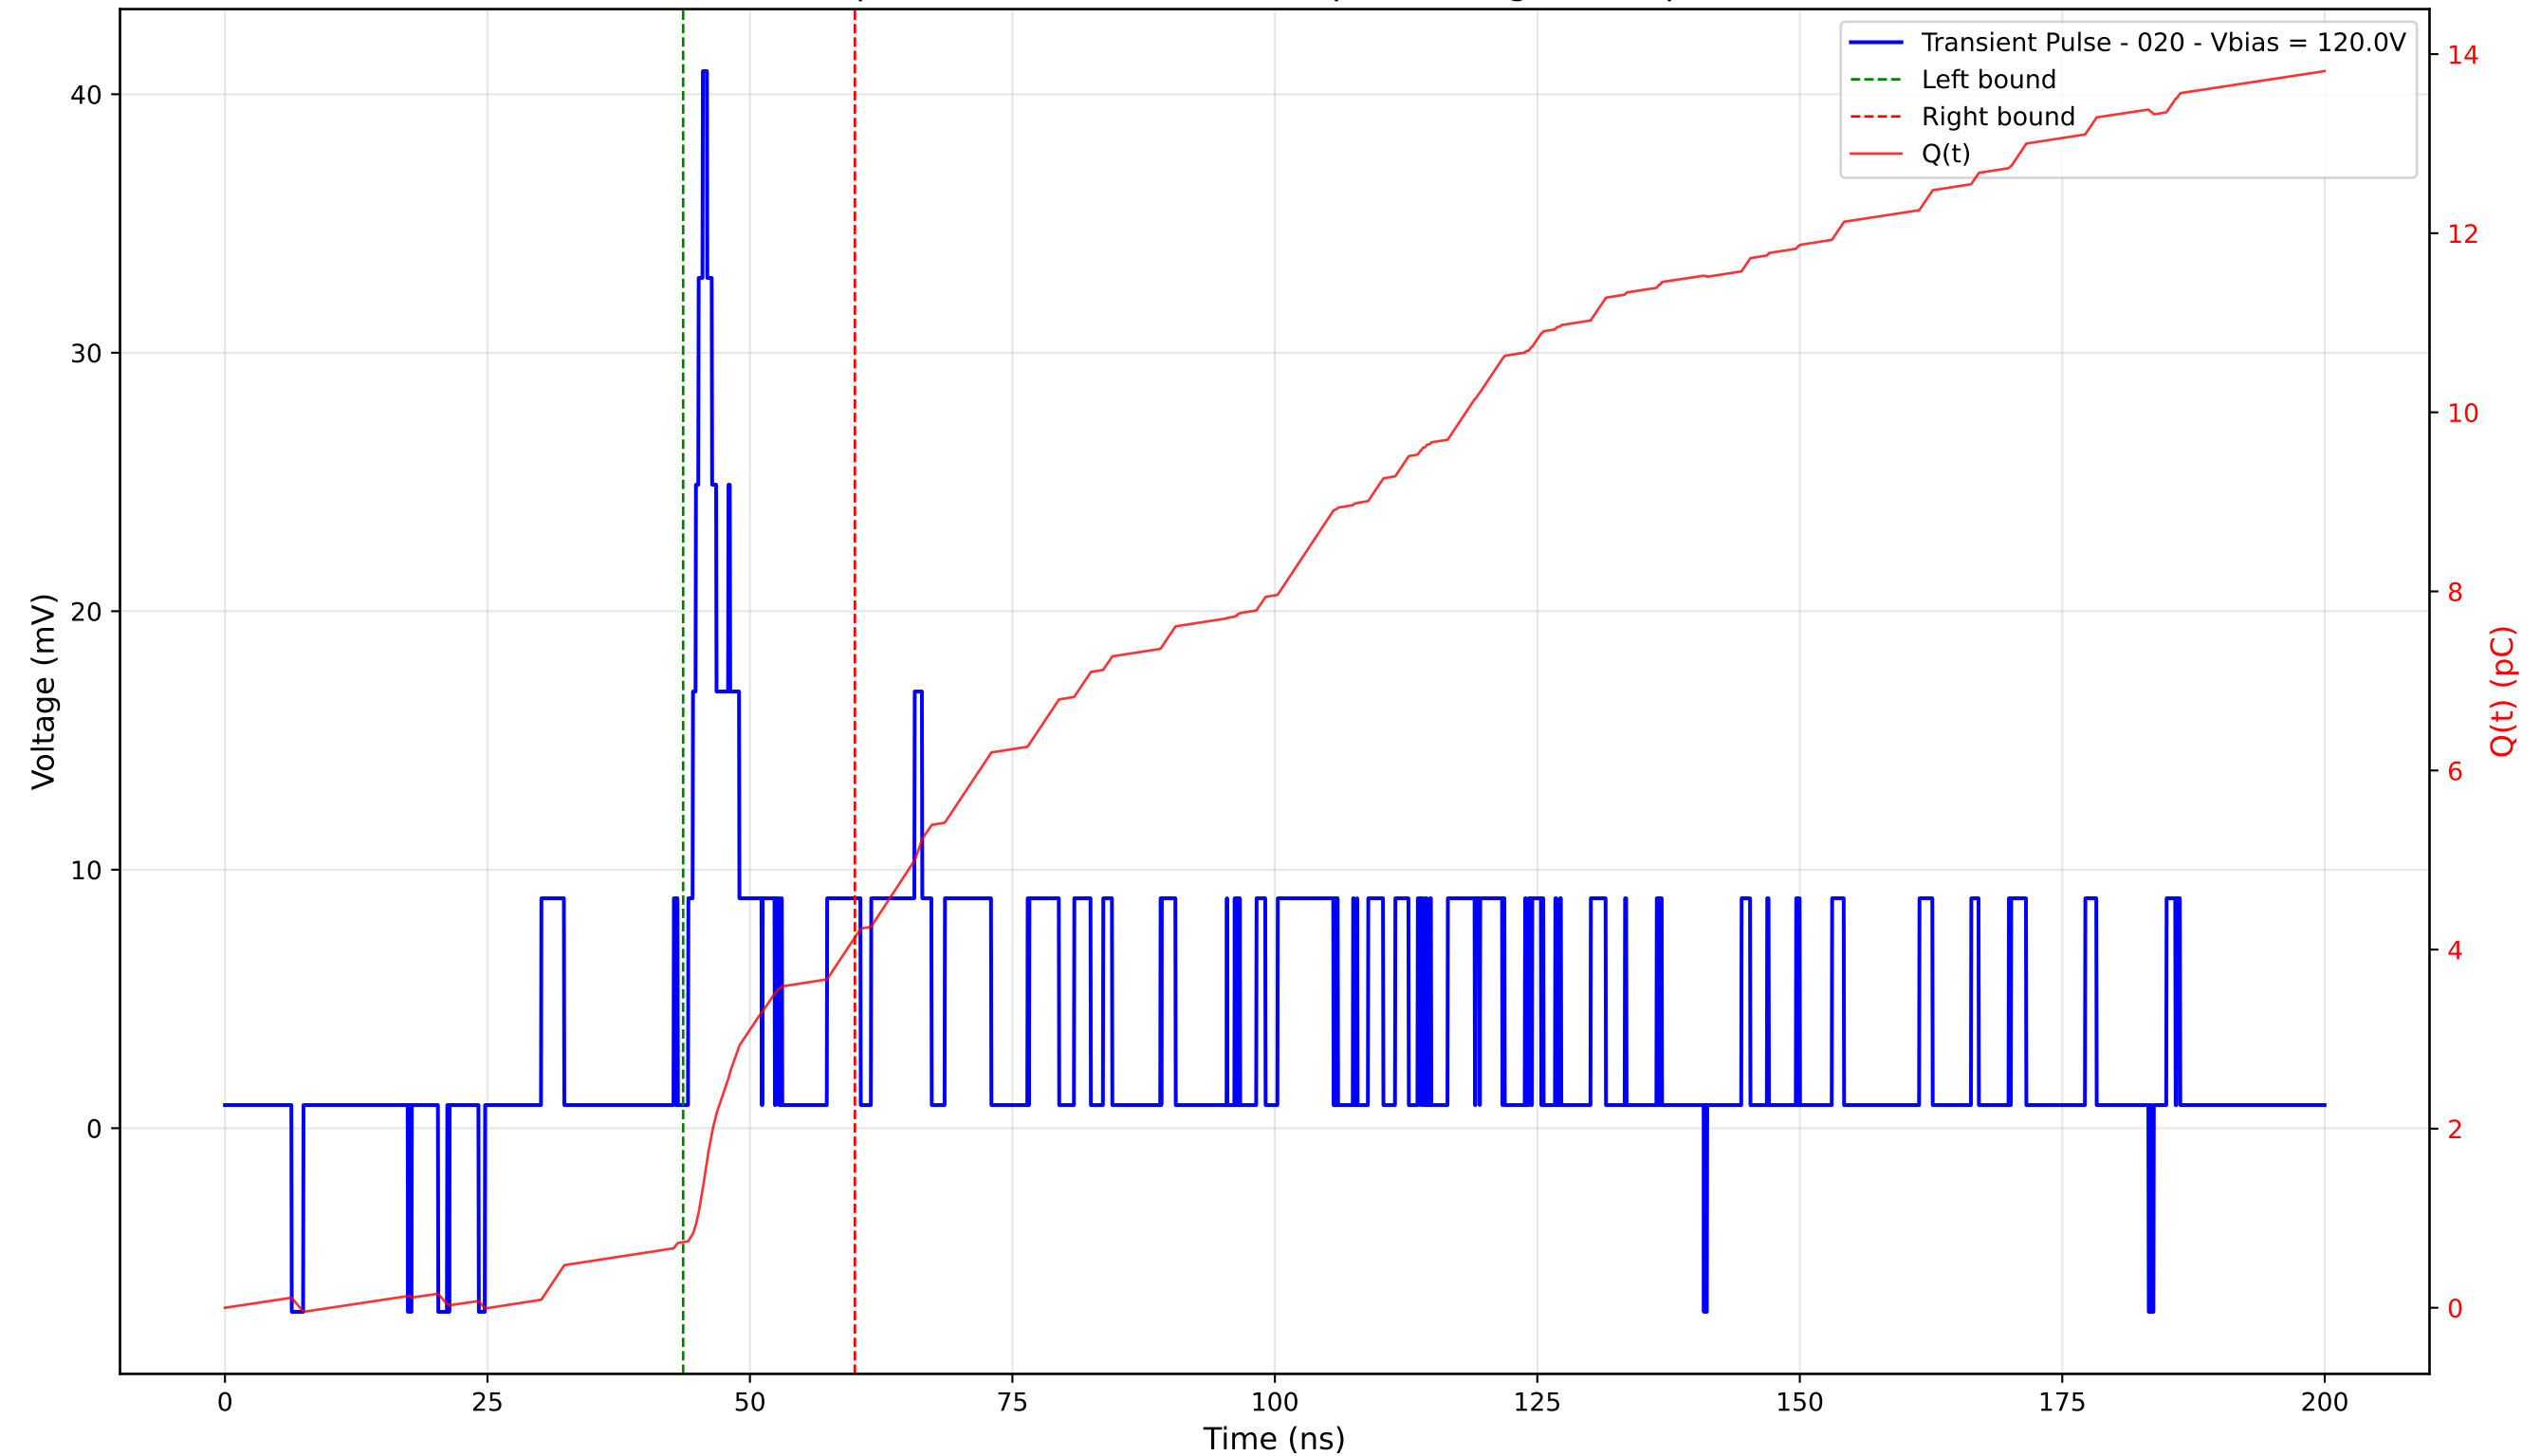


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 3.71 pC - Rise Time: 2.63 ns

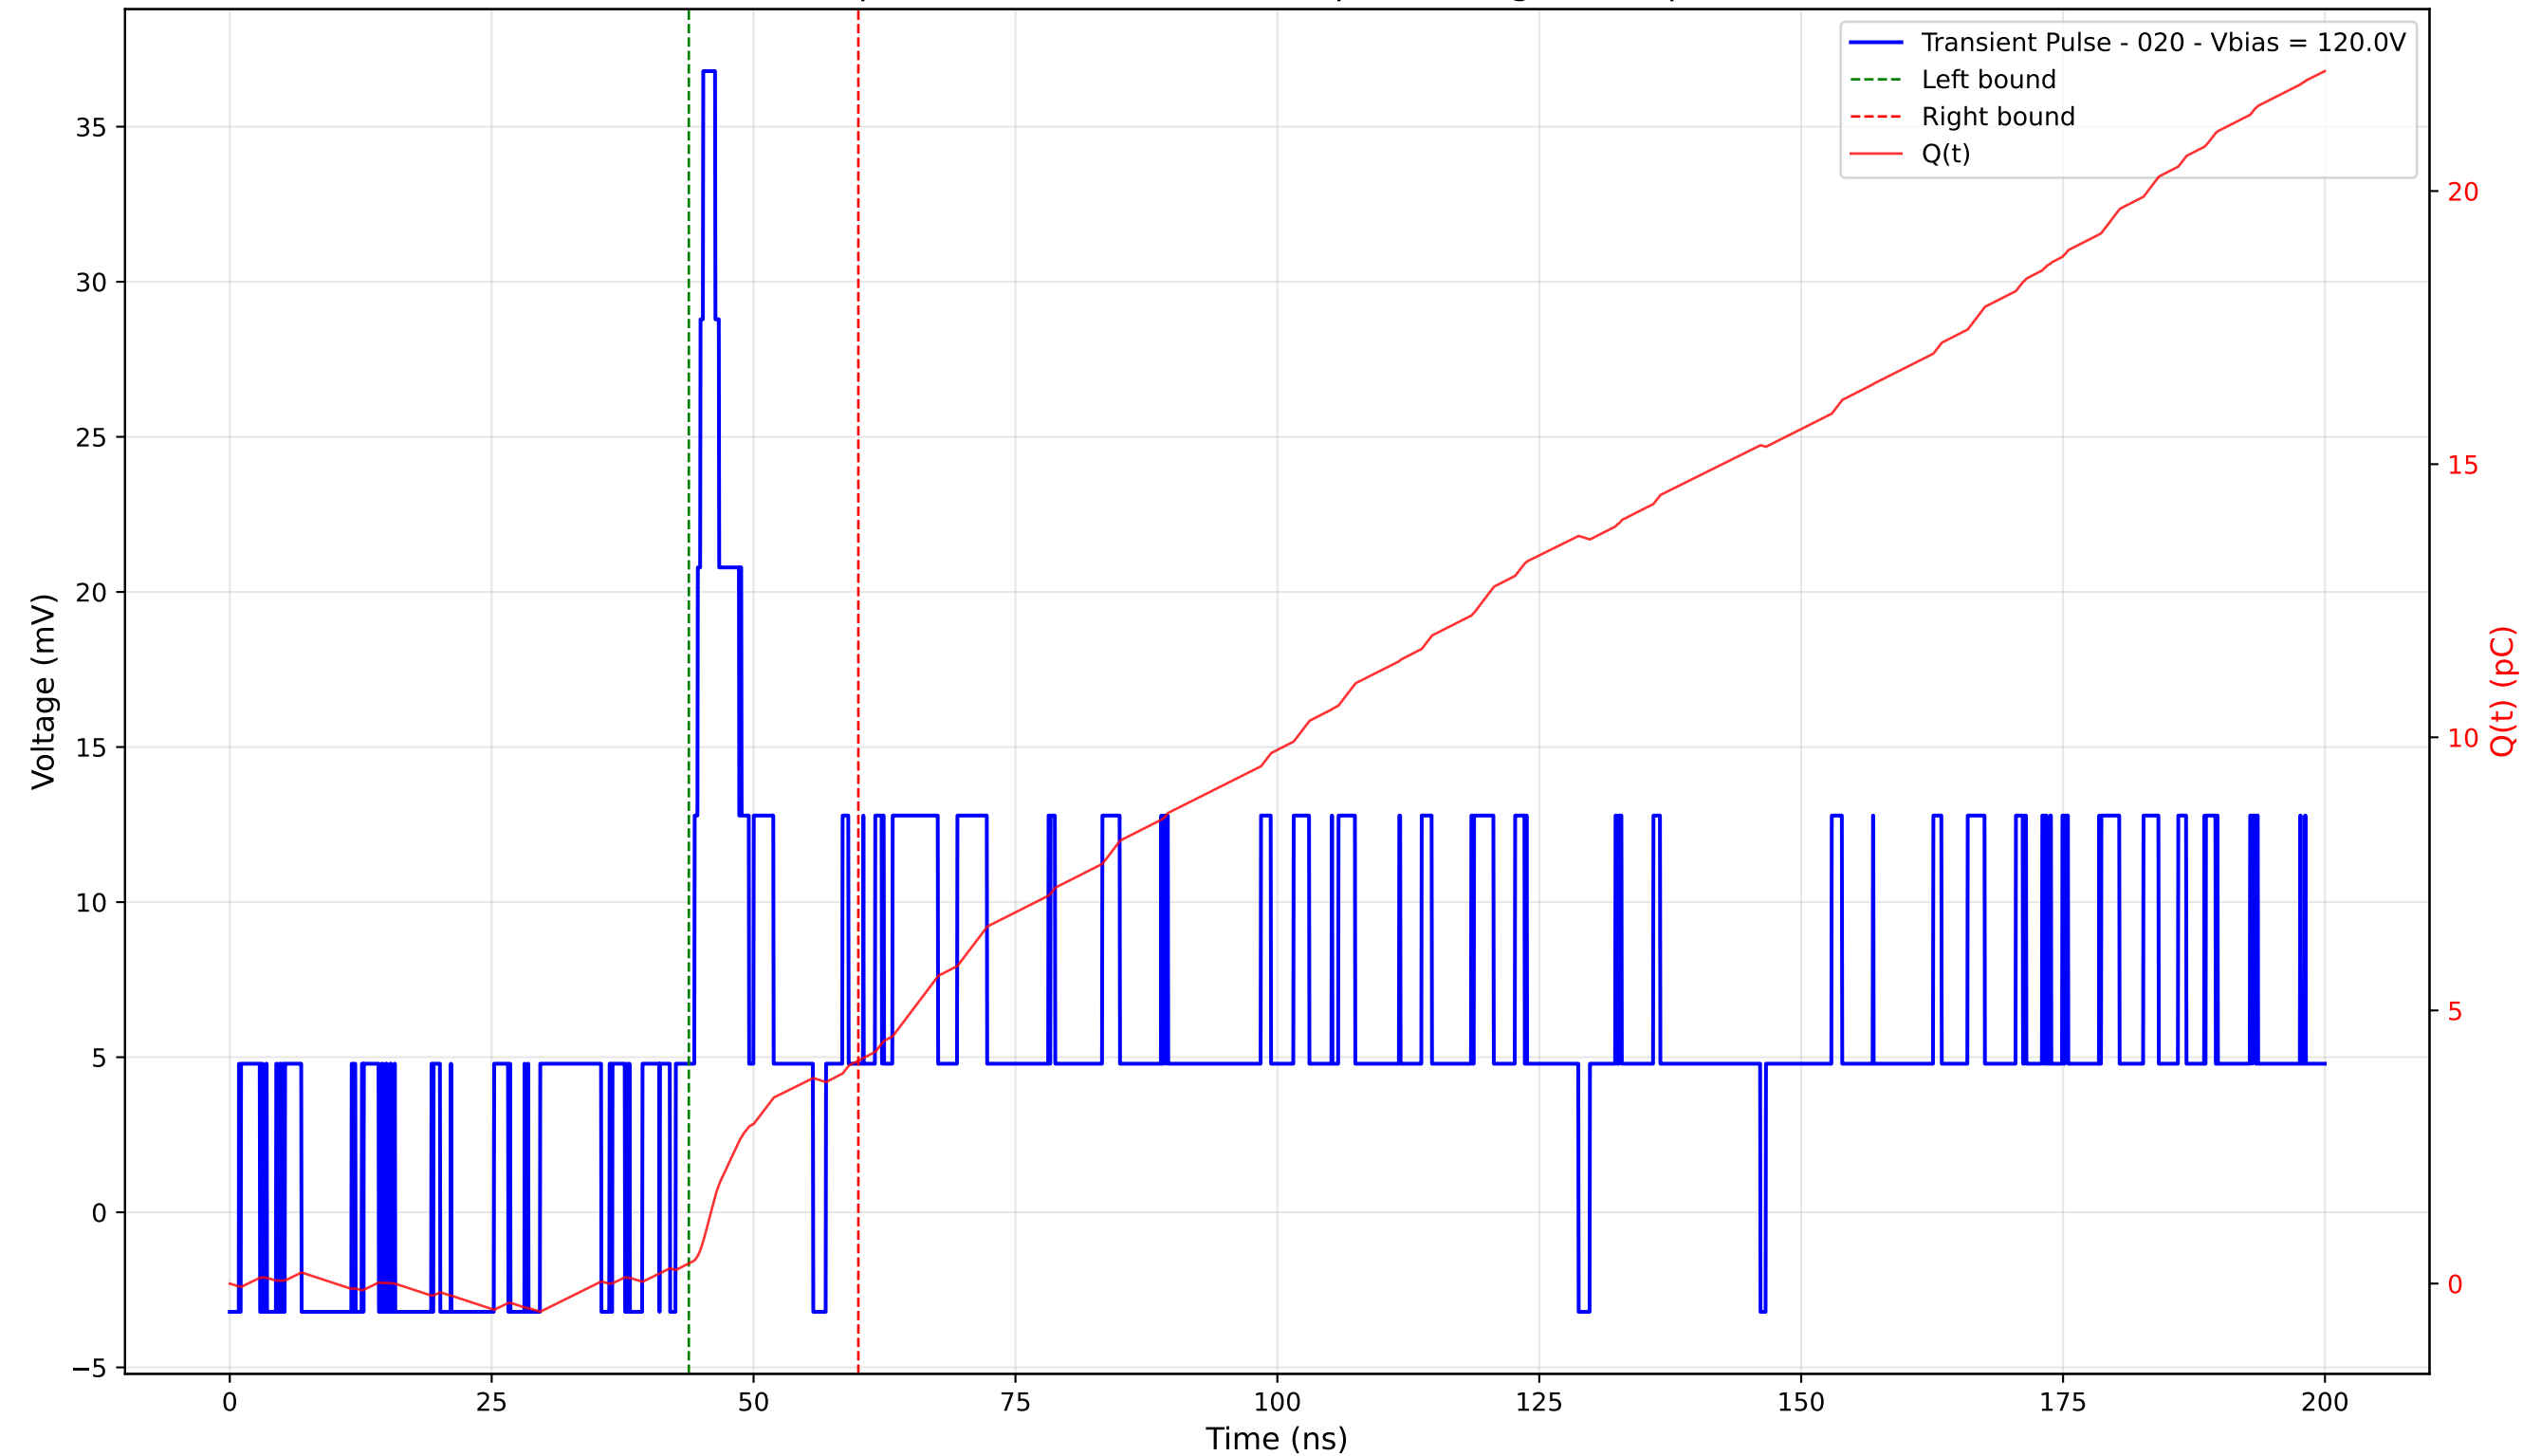


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 4.04 pC - Rise Time: 1.33 ns

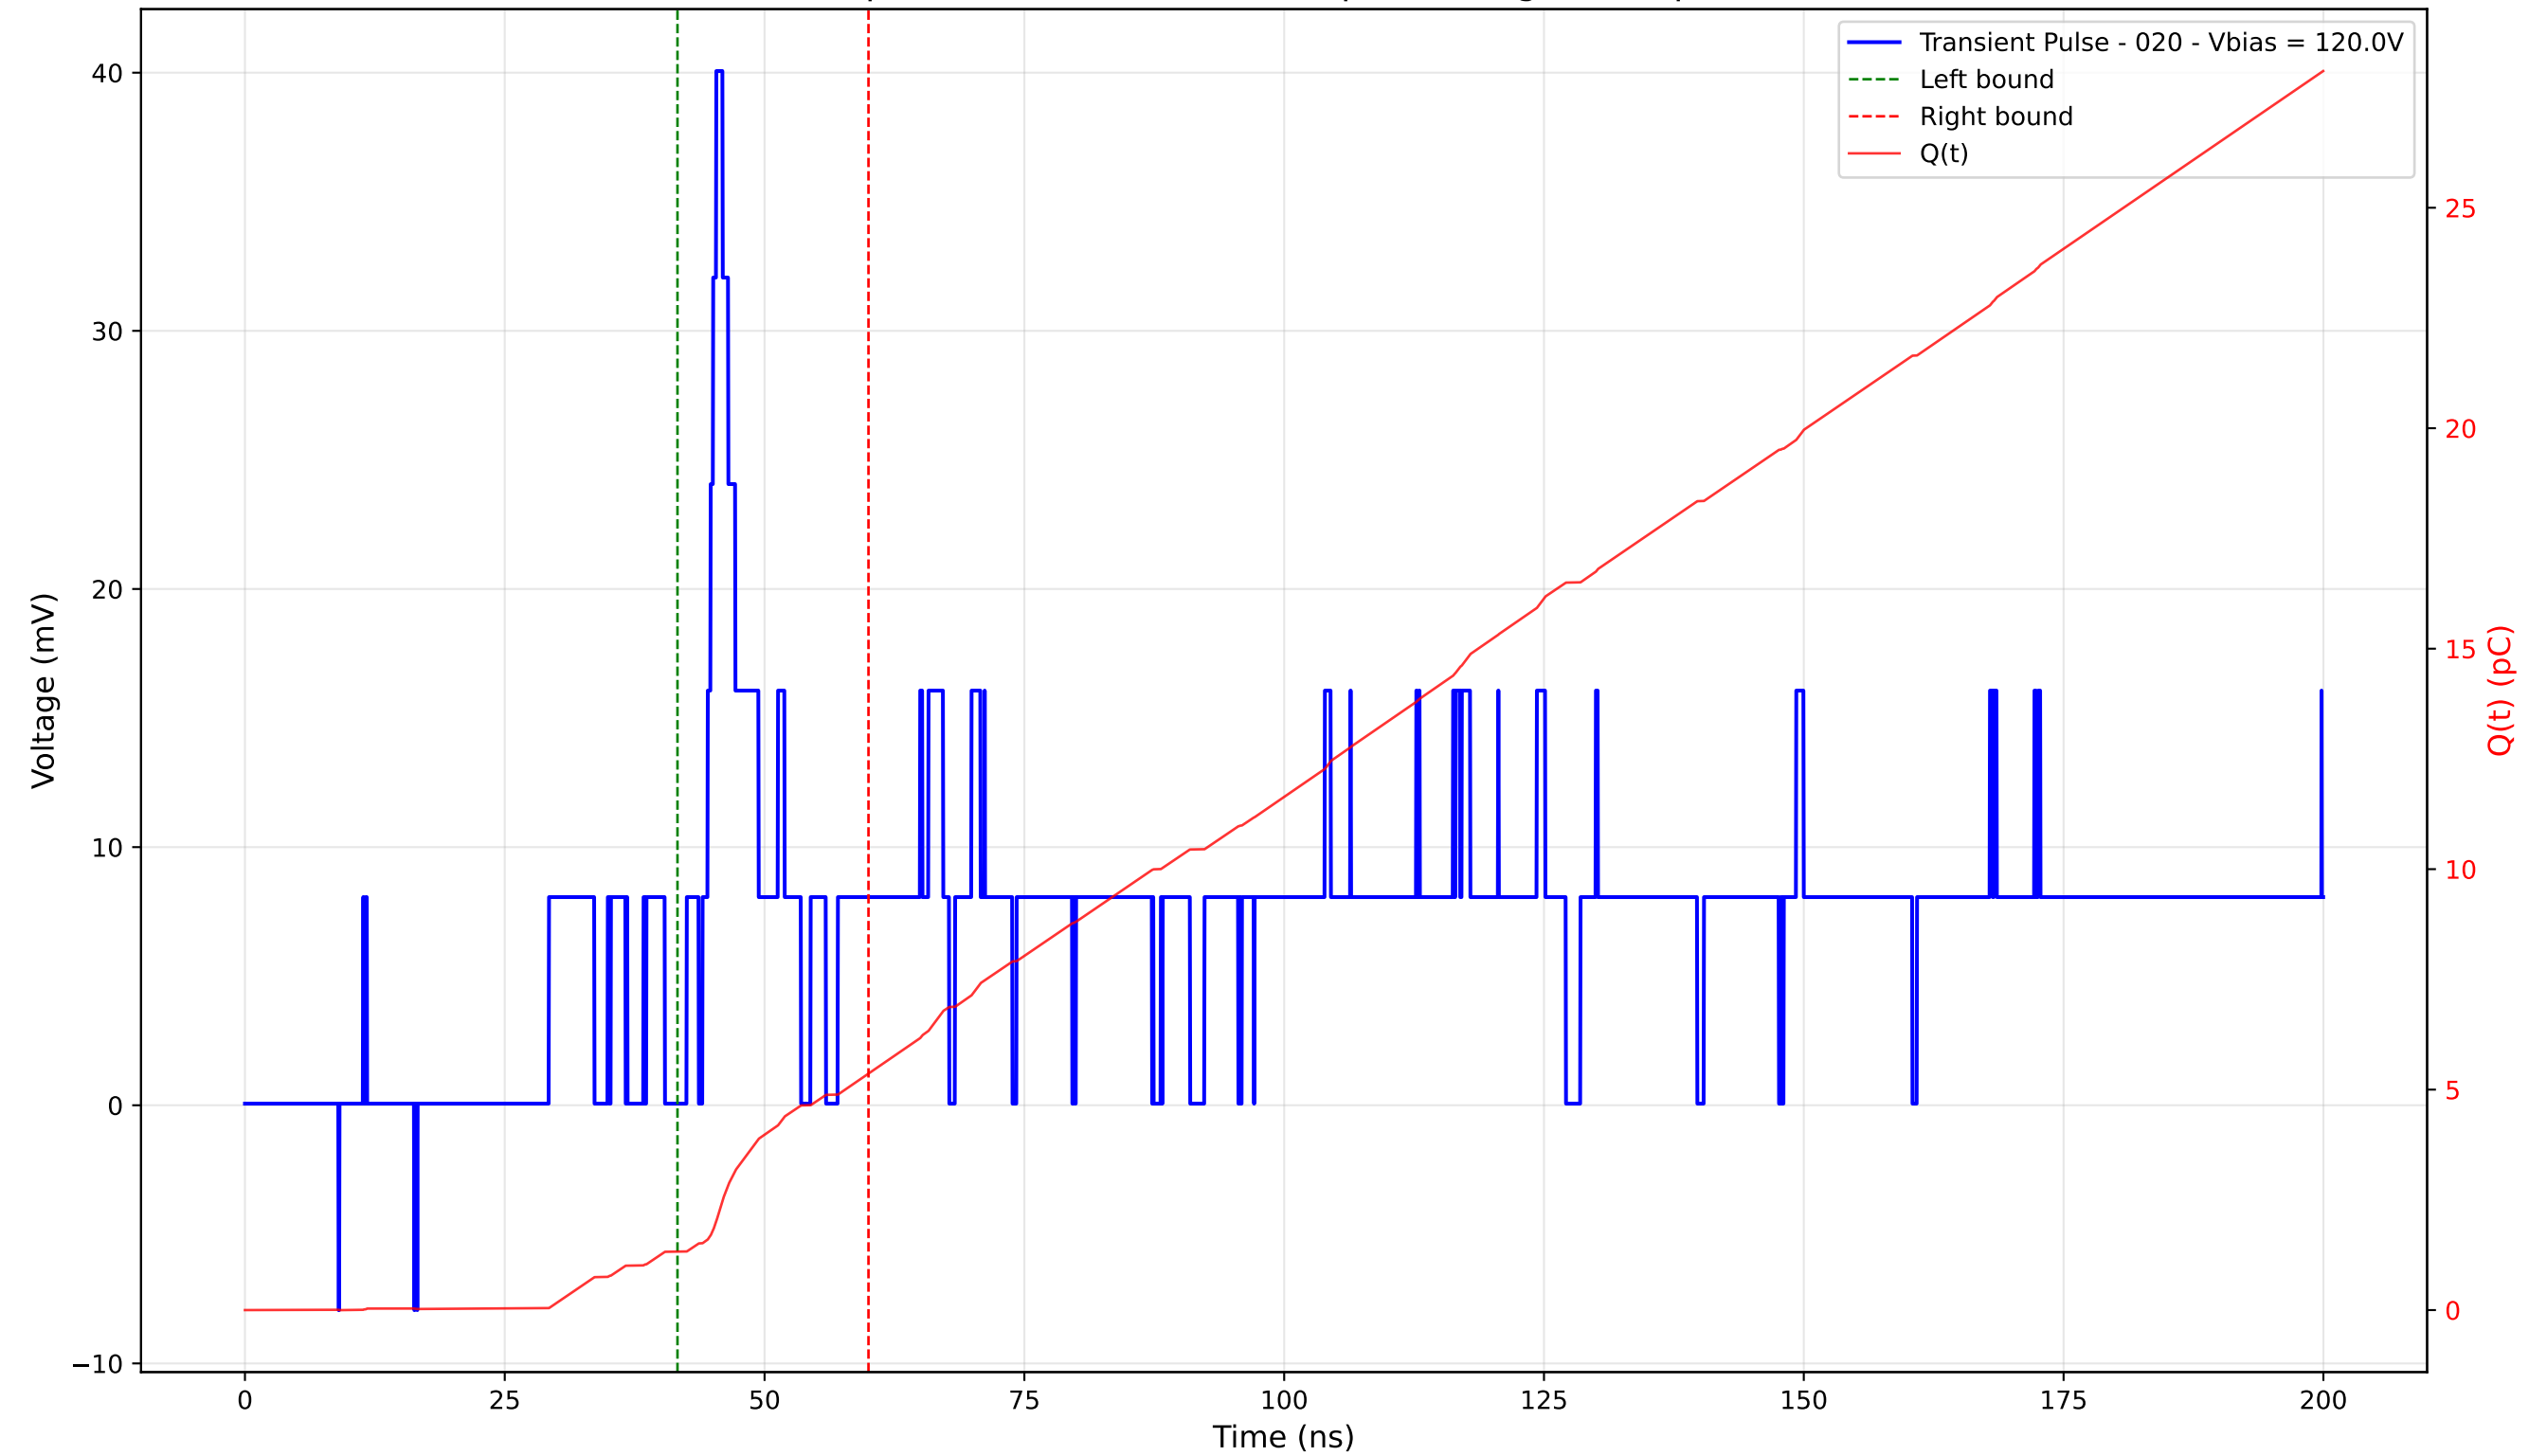


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 2.77 pC - Rise Time: 0.00 ns (N/A)

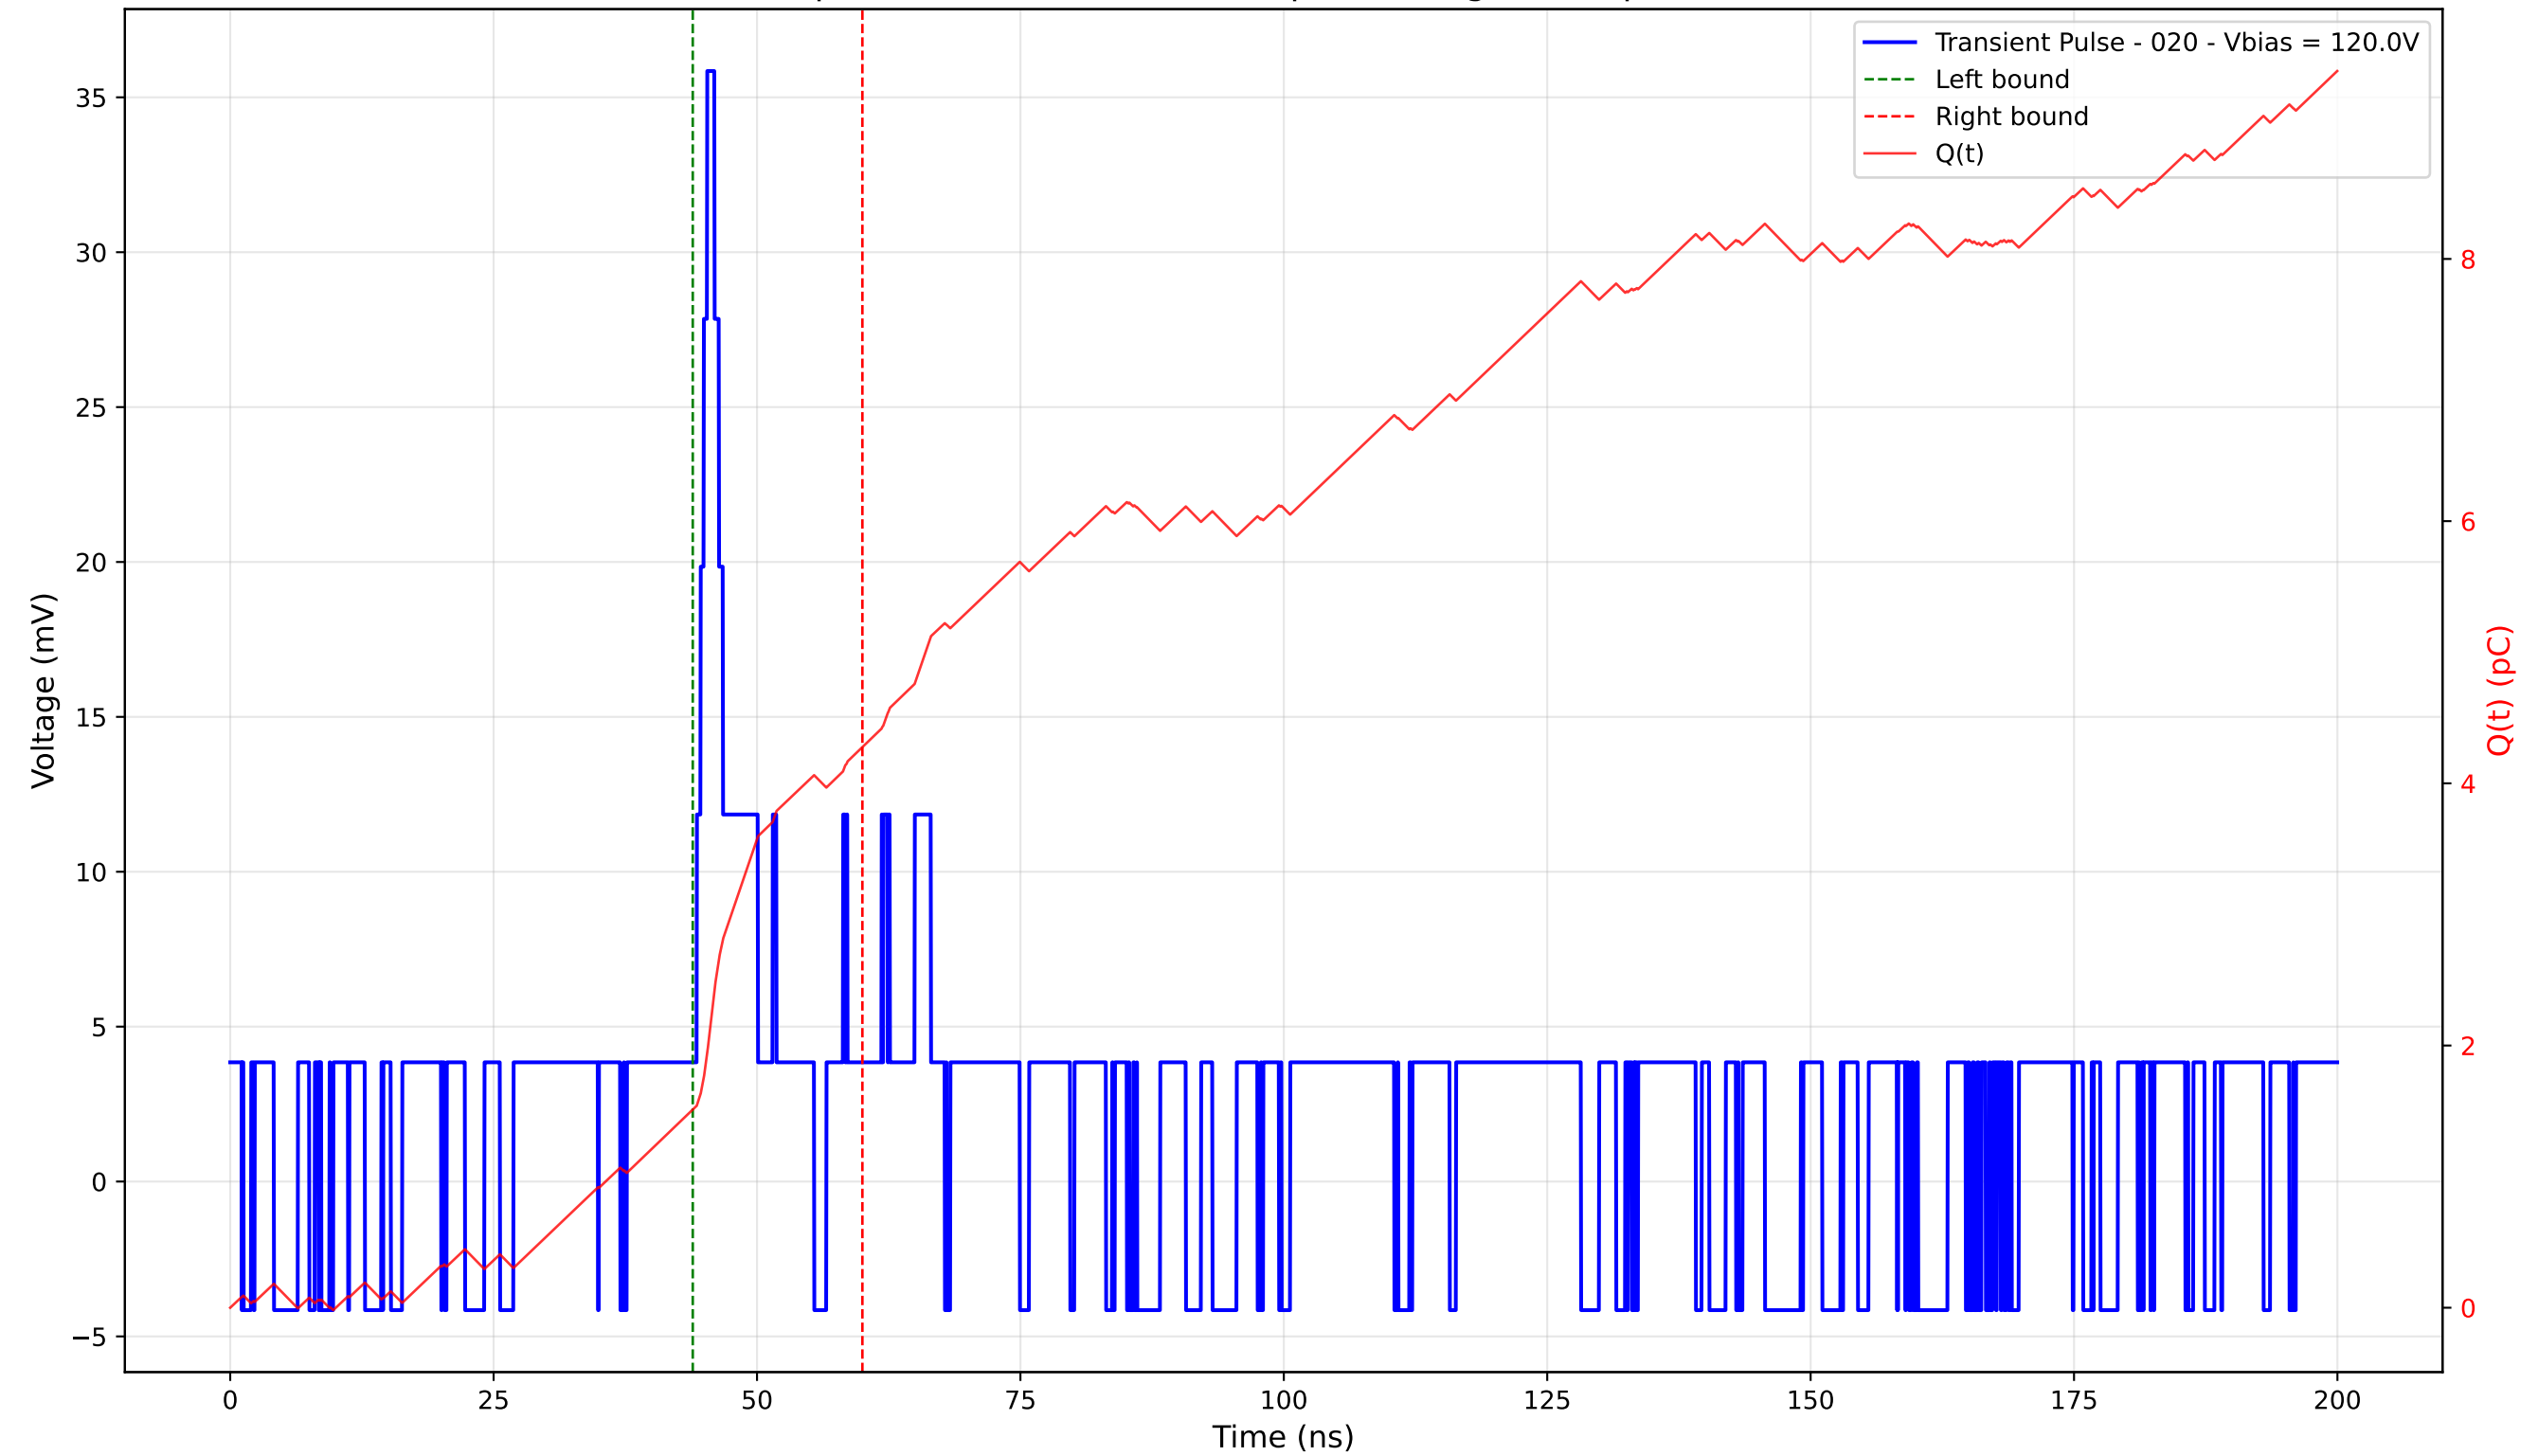


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 2.55 pC - Rise Time: 0.74 ns

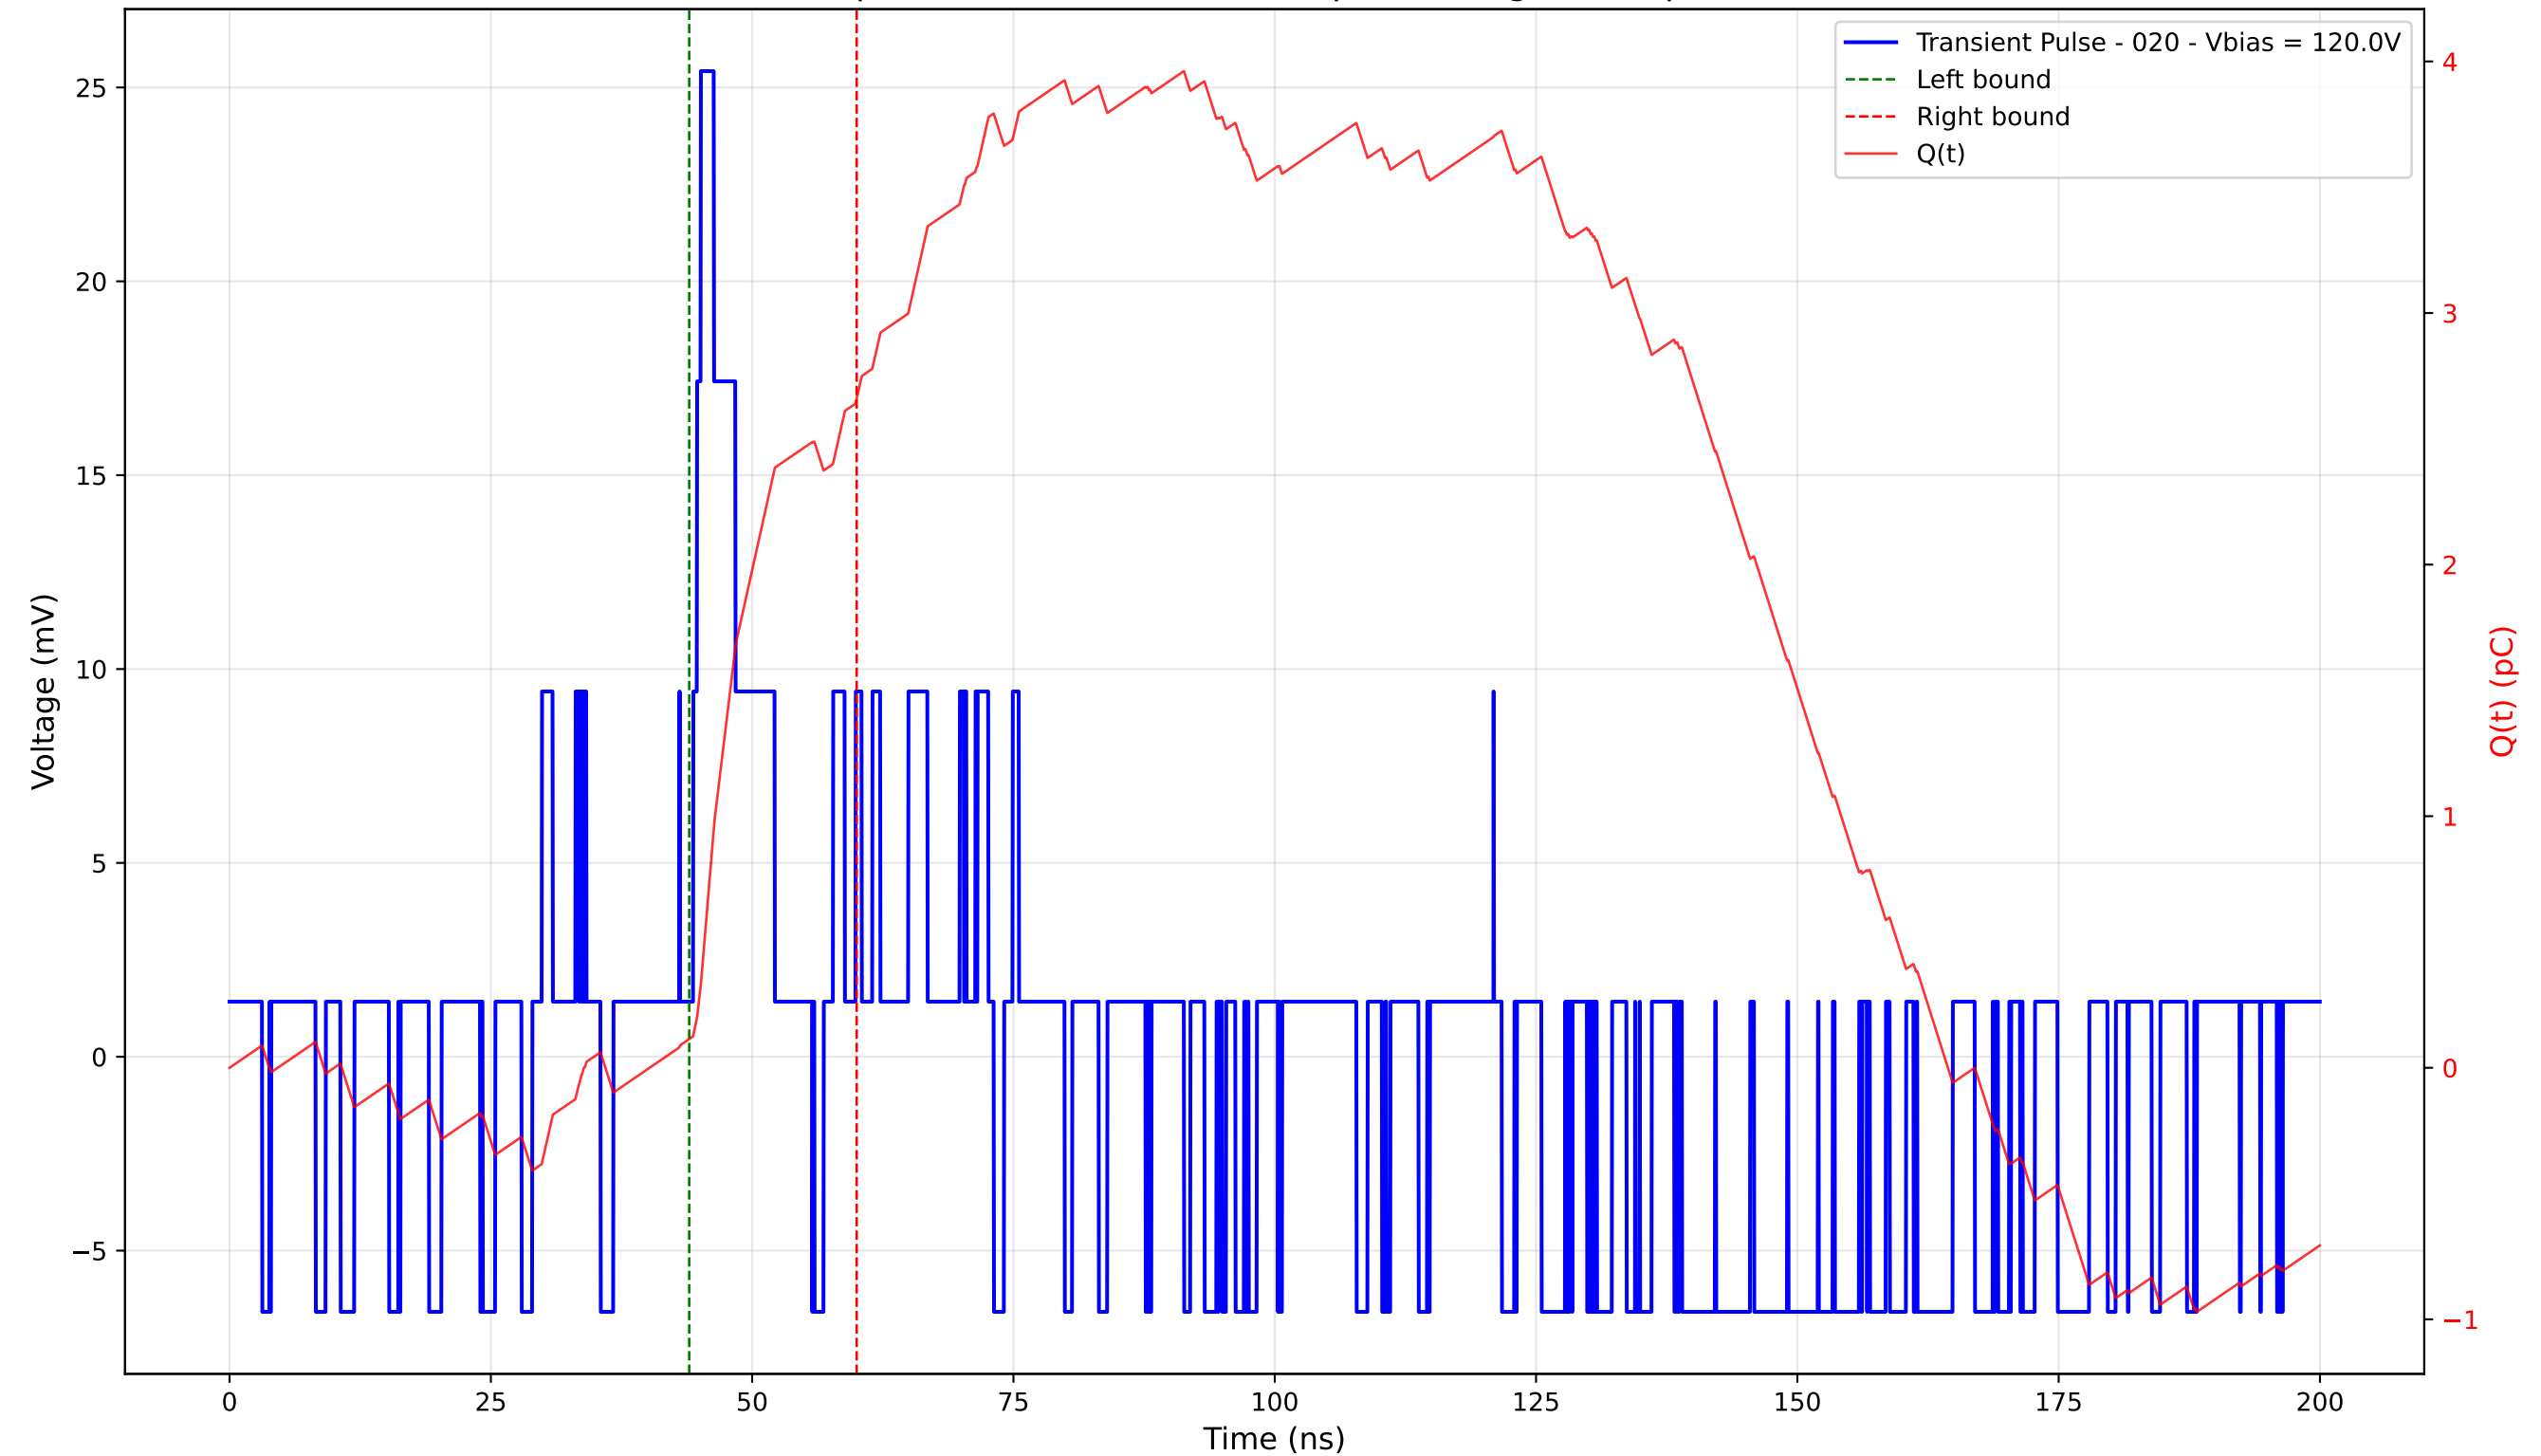


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 3.09 pC - Rise Time: 0.00 ns (N/A)

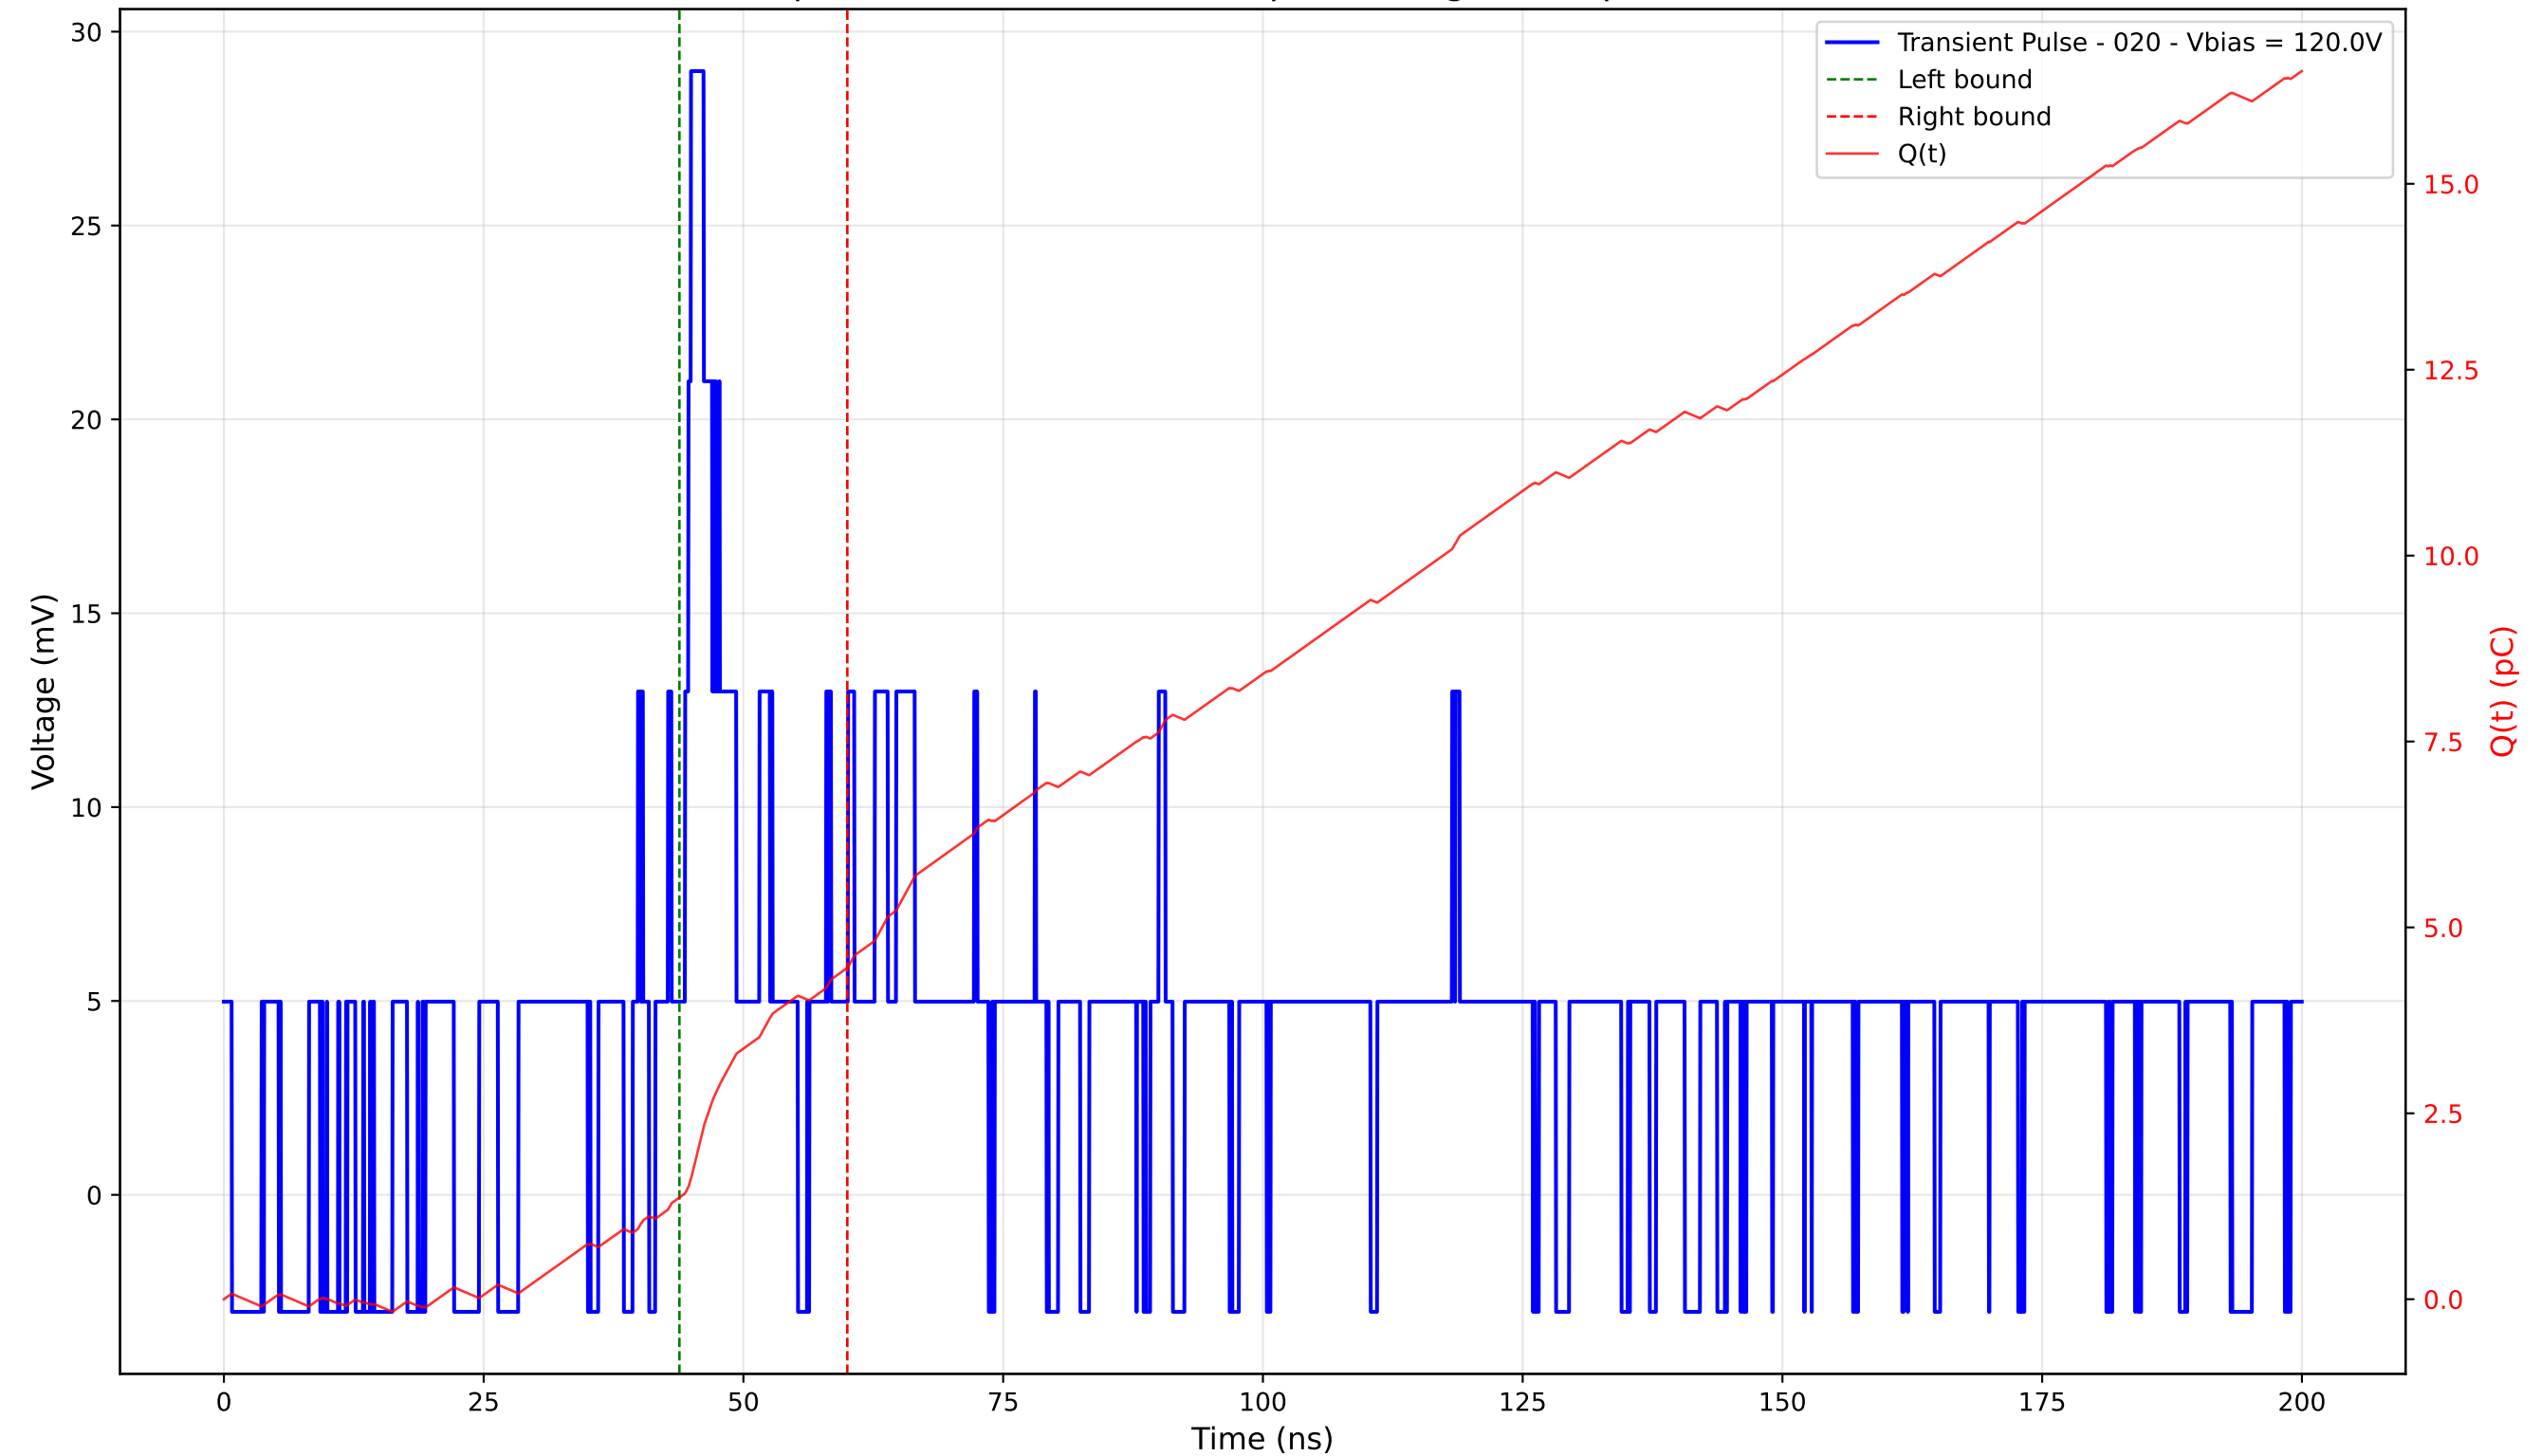


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 3.12 pC - Rise Time: 0.94 ns

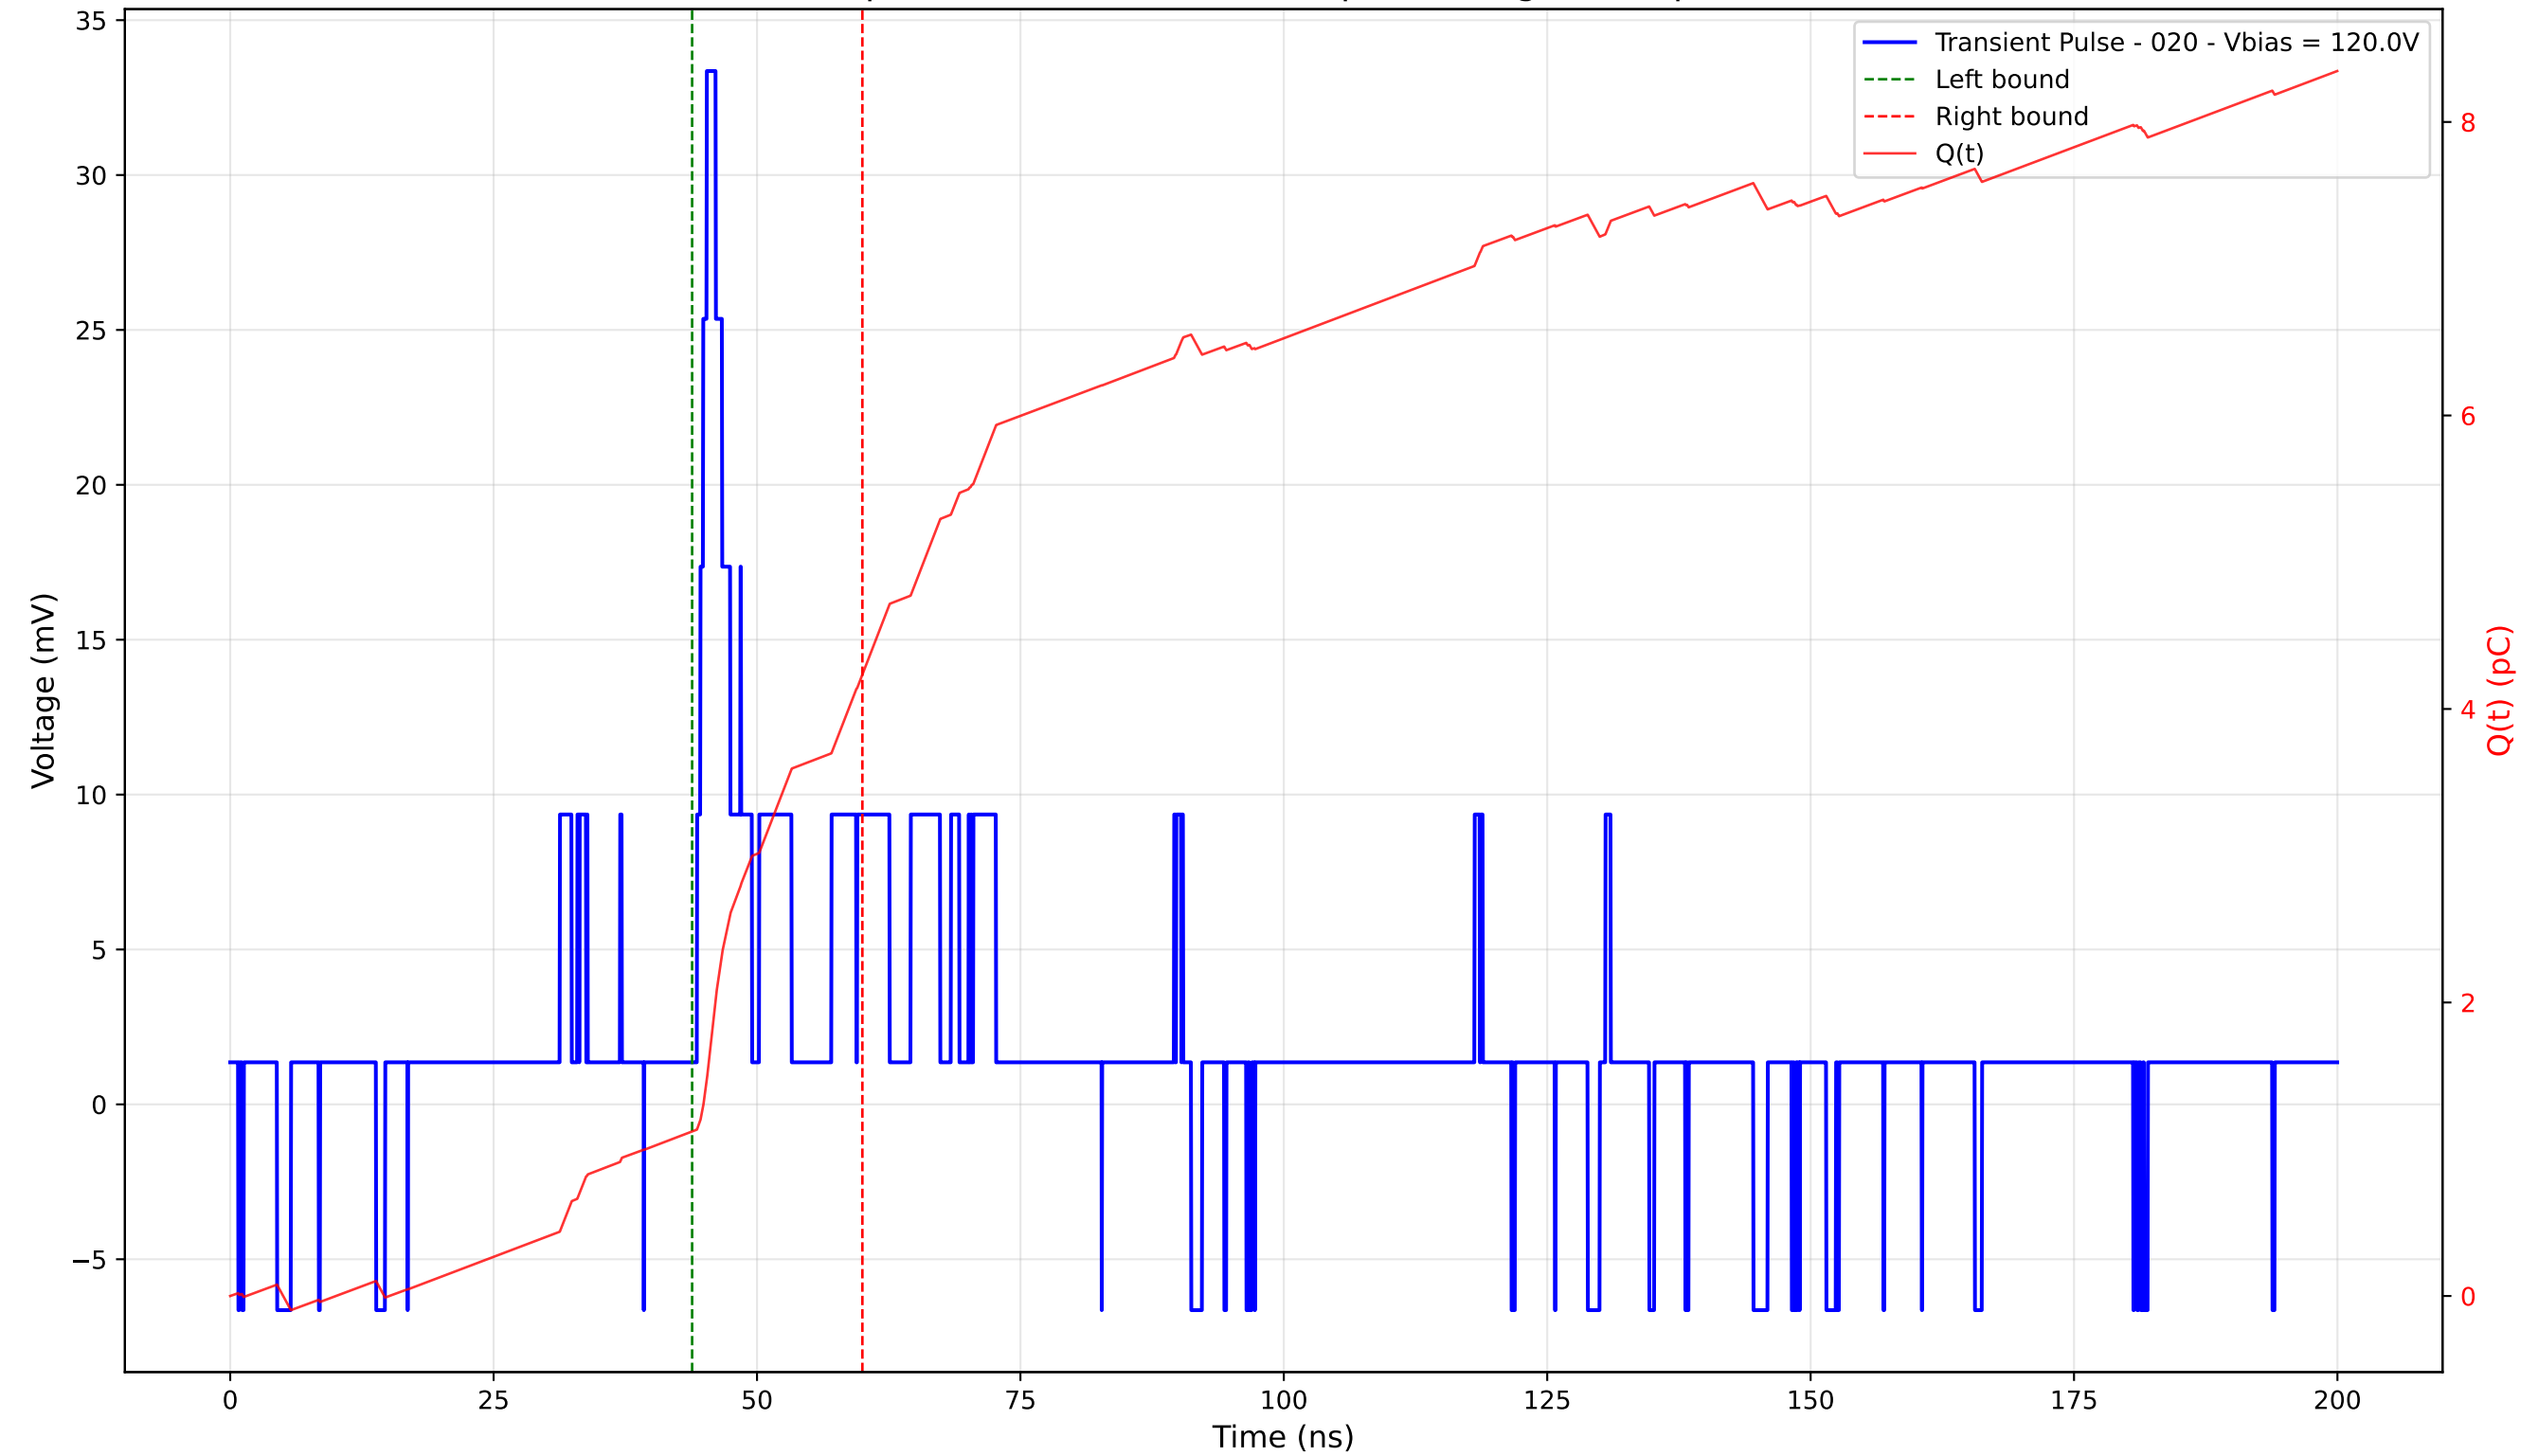


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 3.60 pC - Rise Time: 3.73 ns

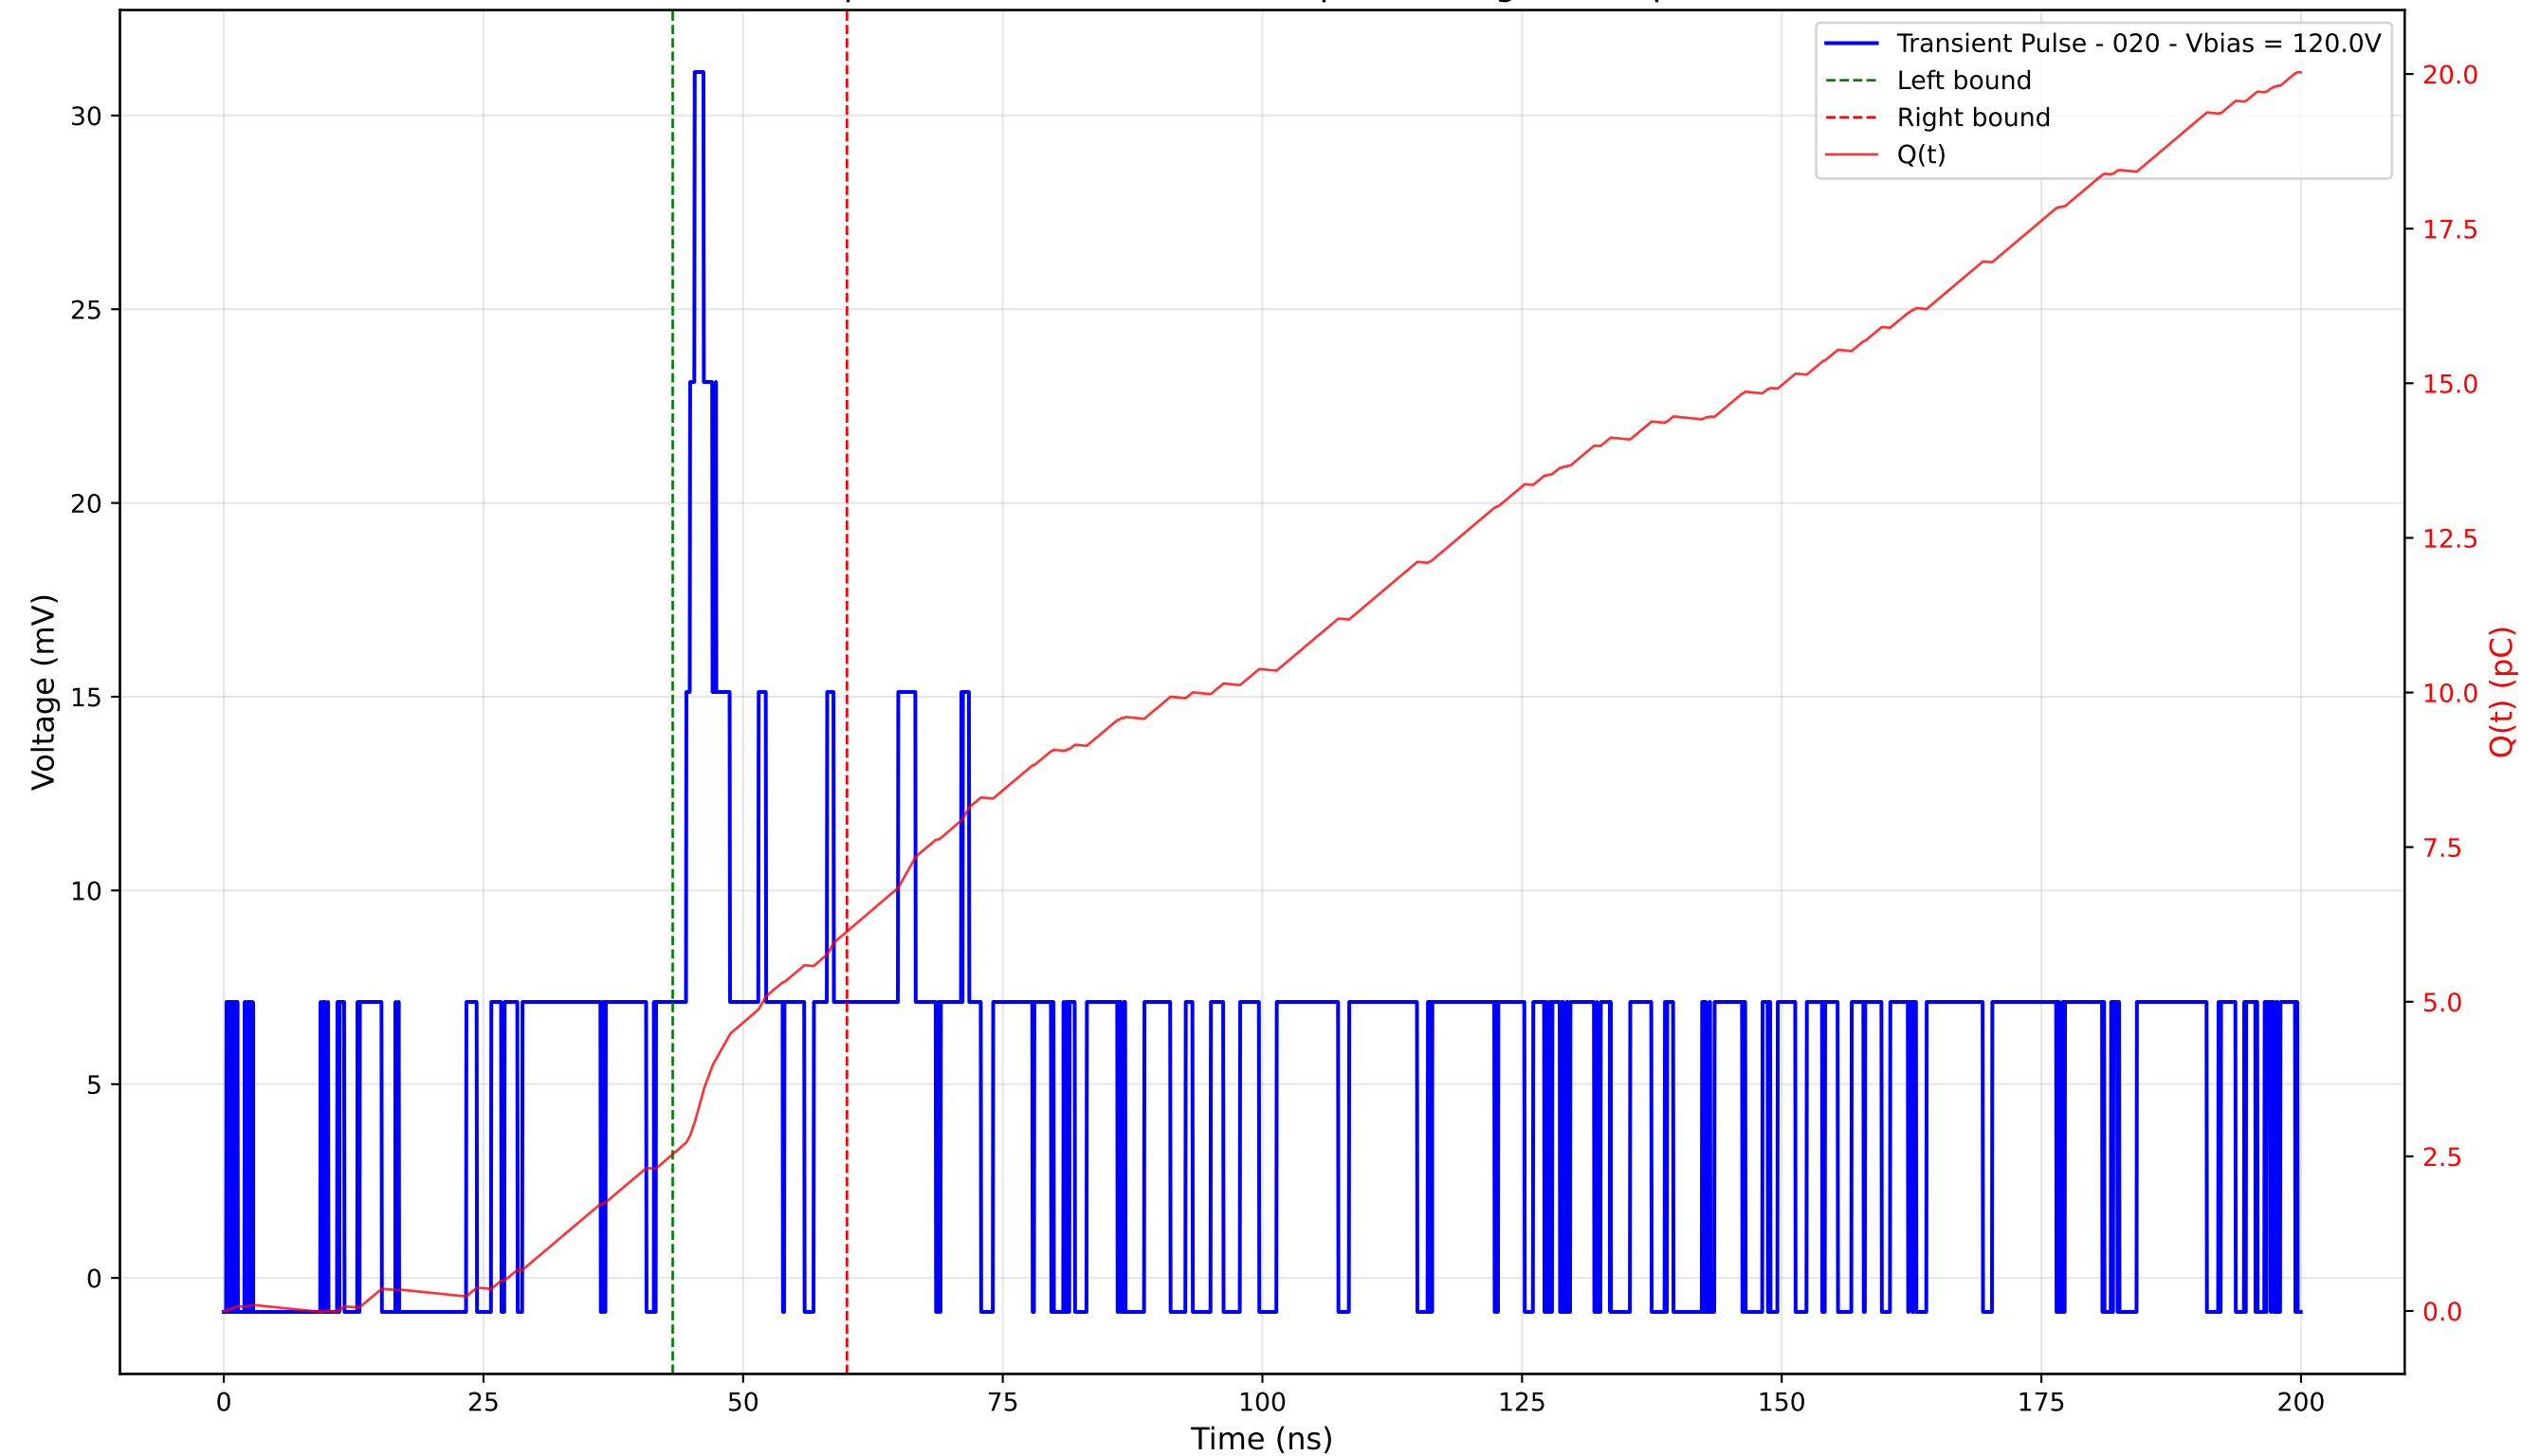


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 2.71 pC - Rise Time: 0.86 ns

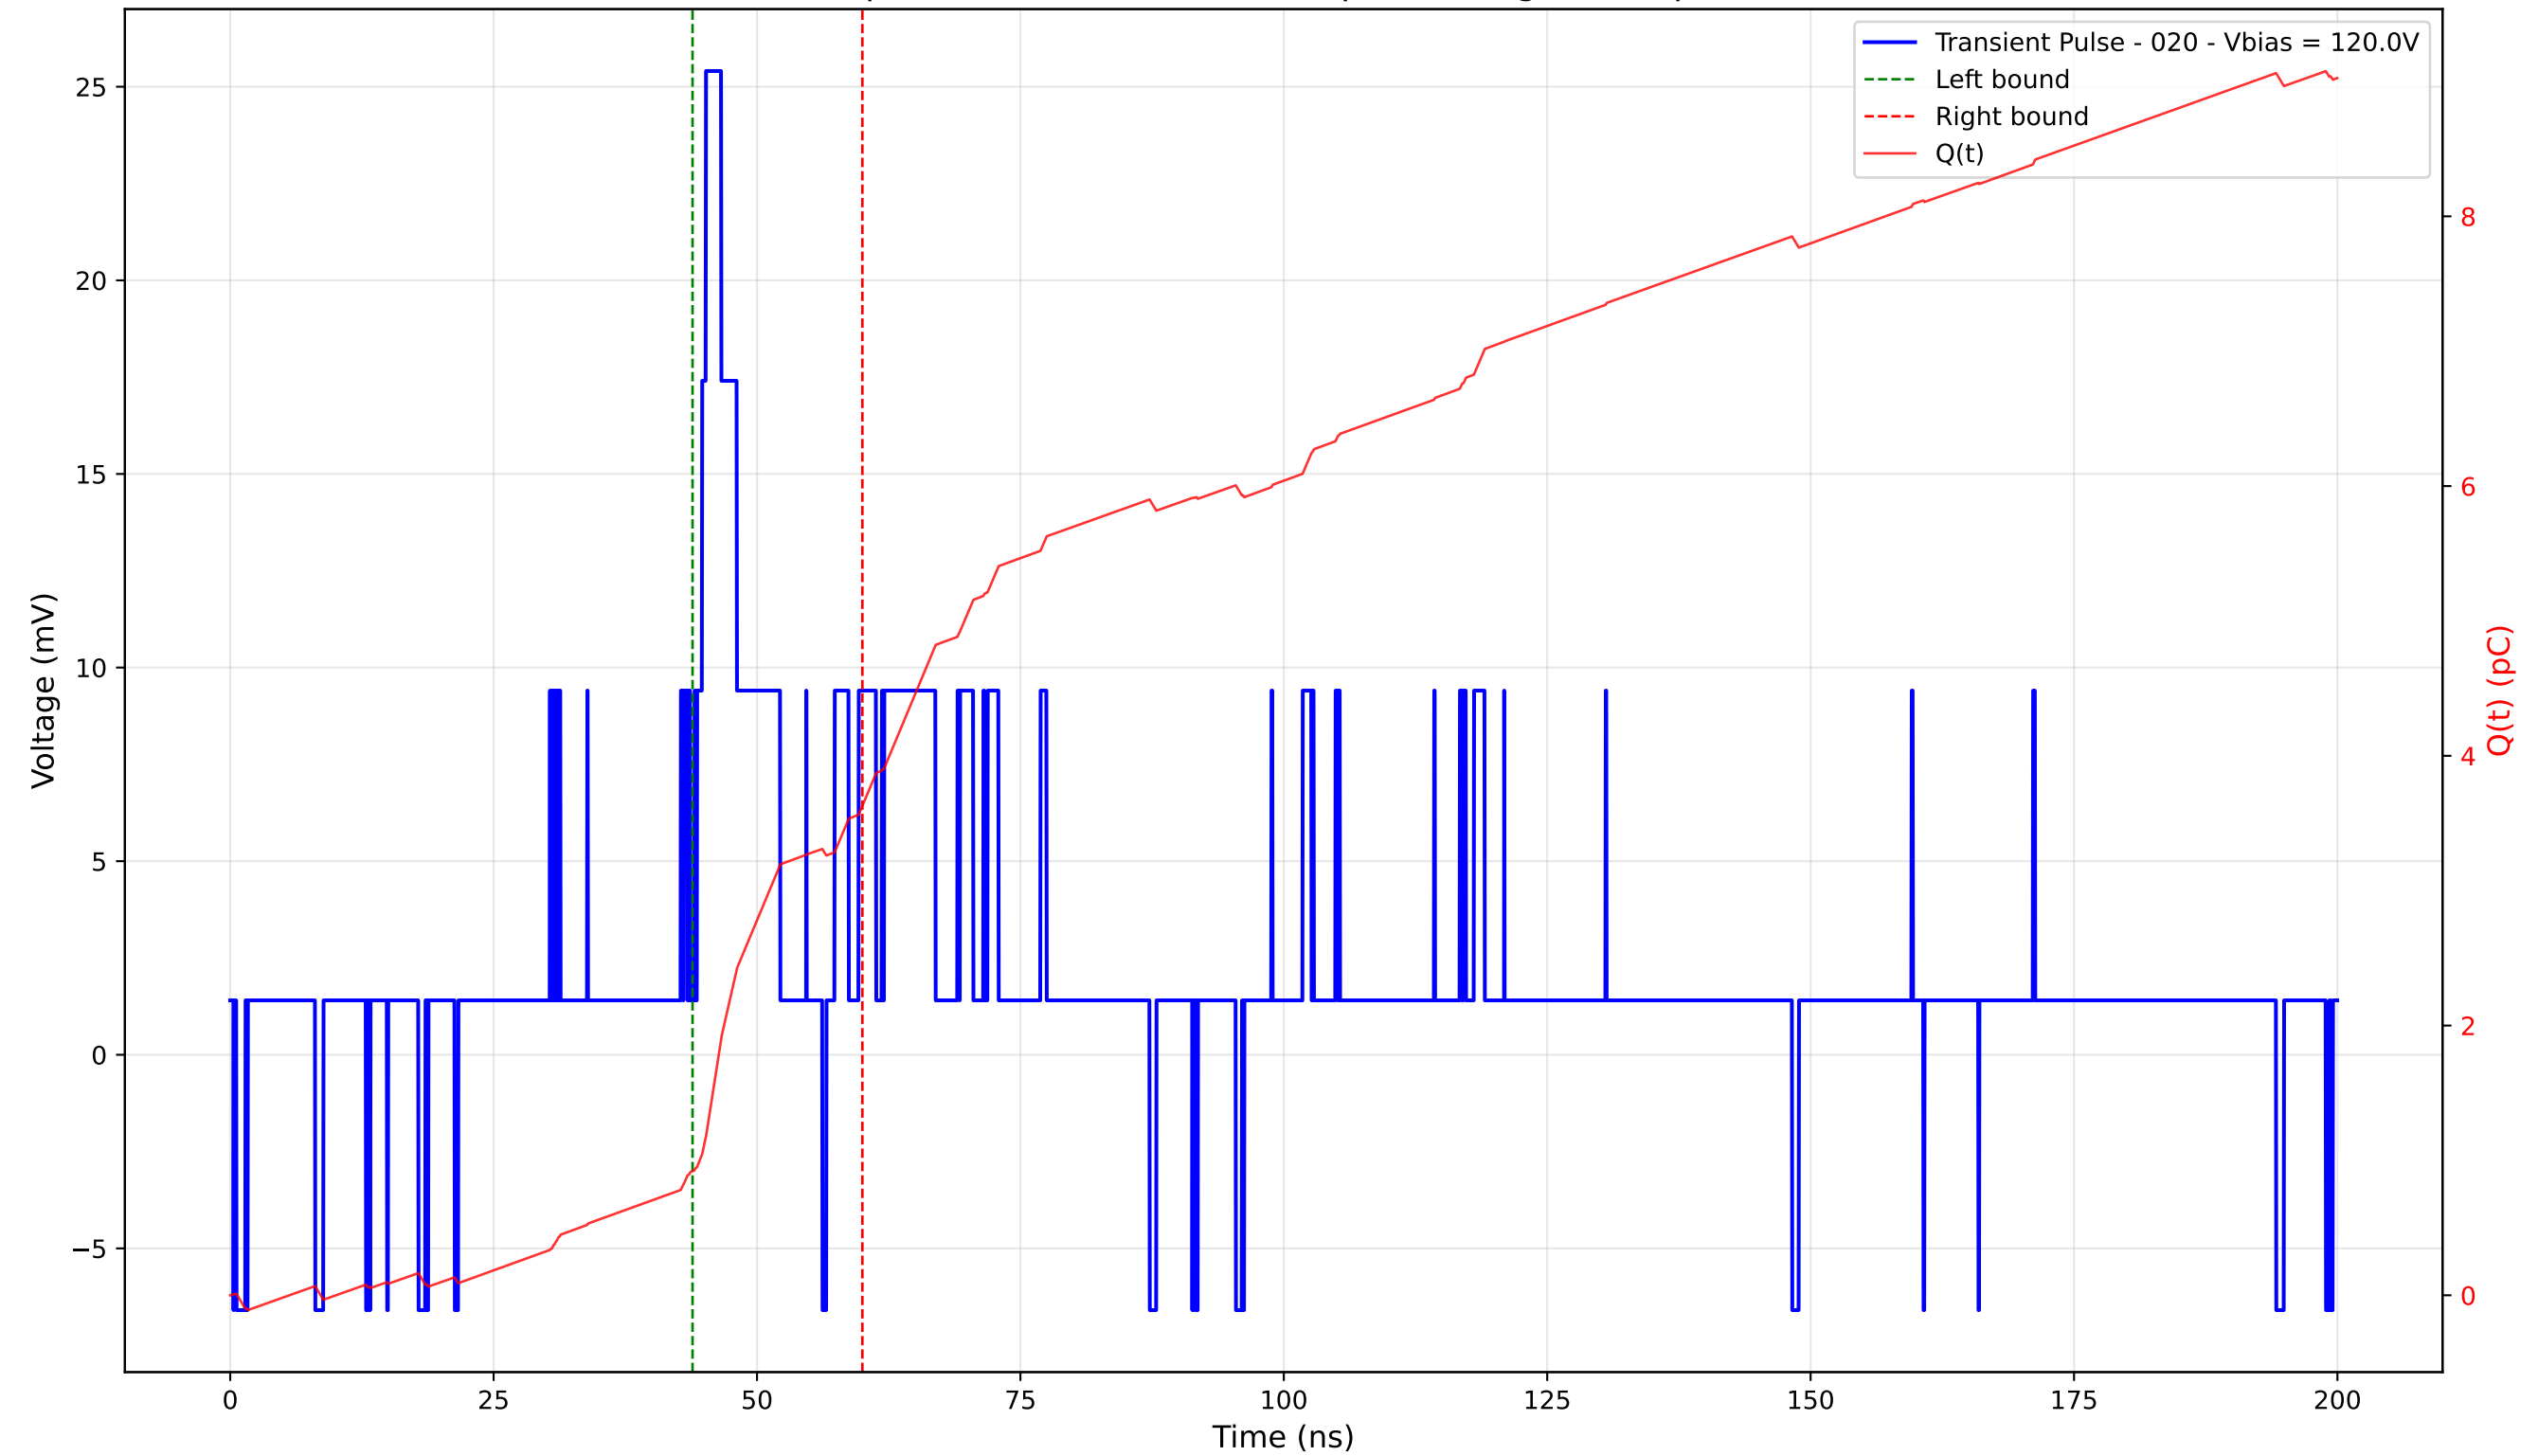


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 3.21 pC - Rise Time: 1.44 ns

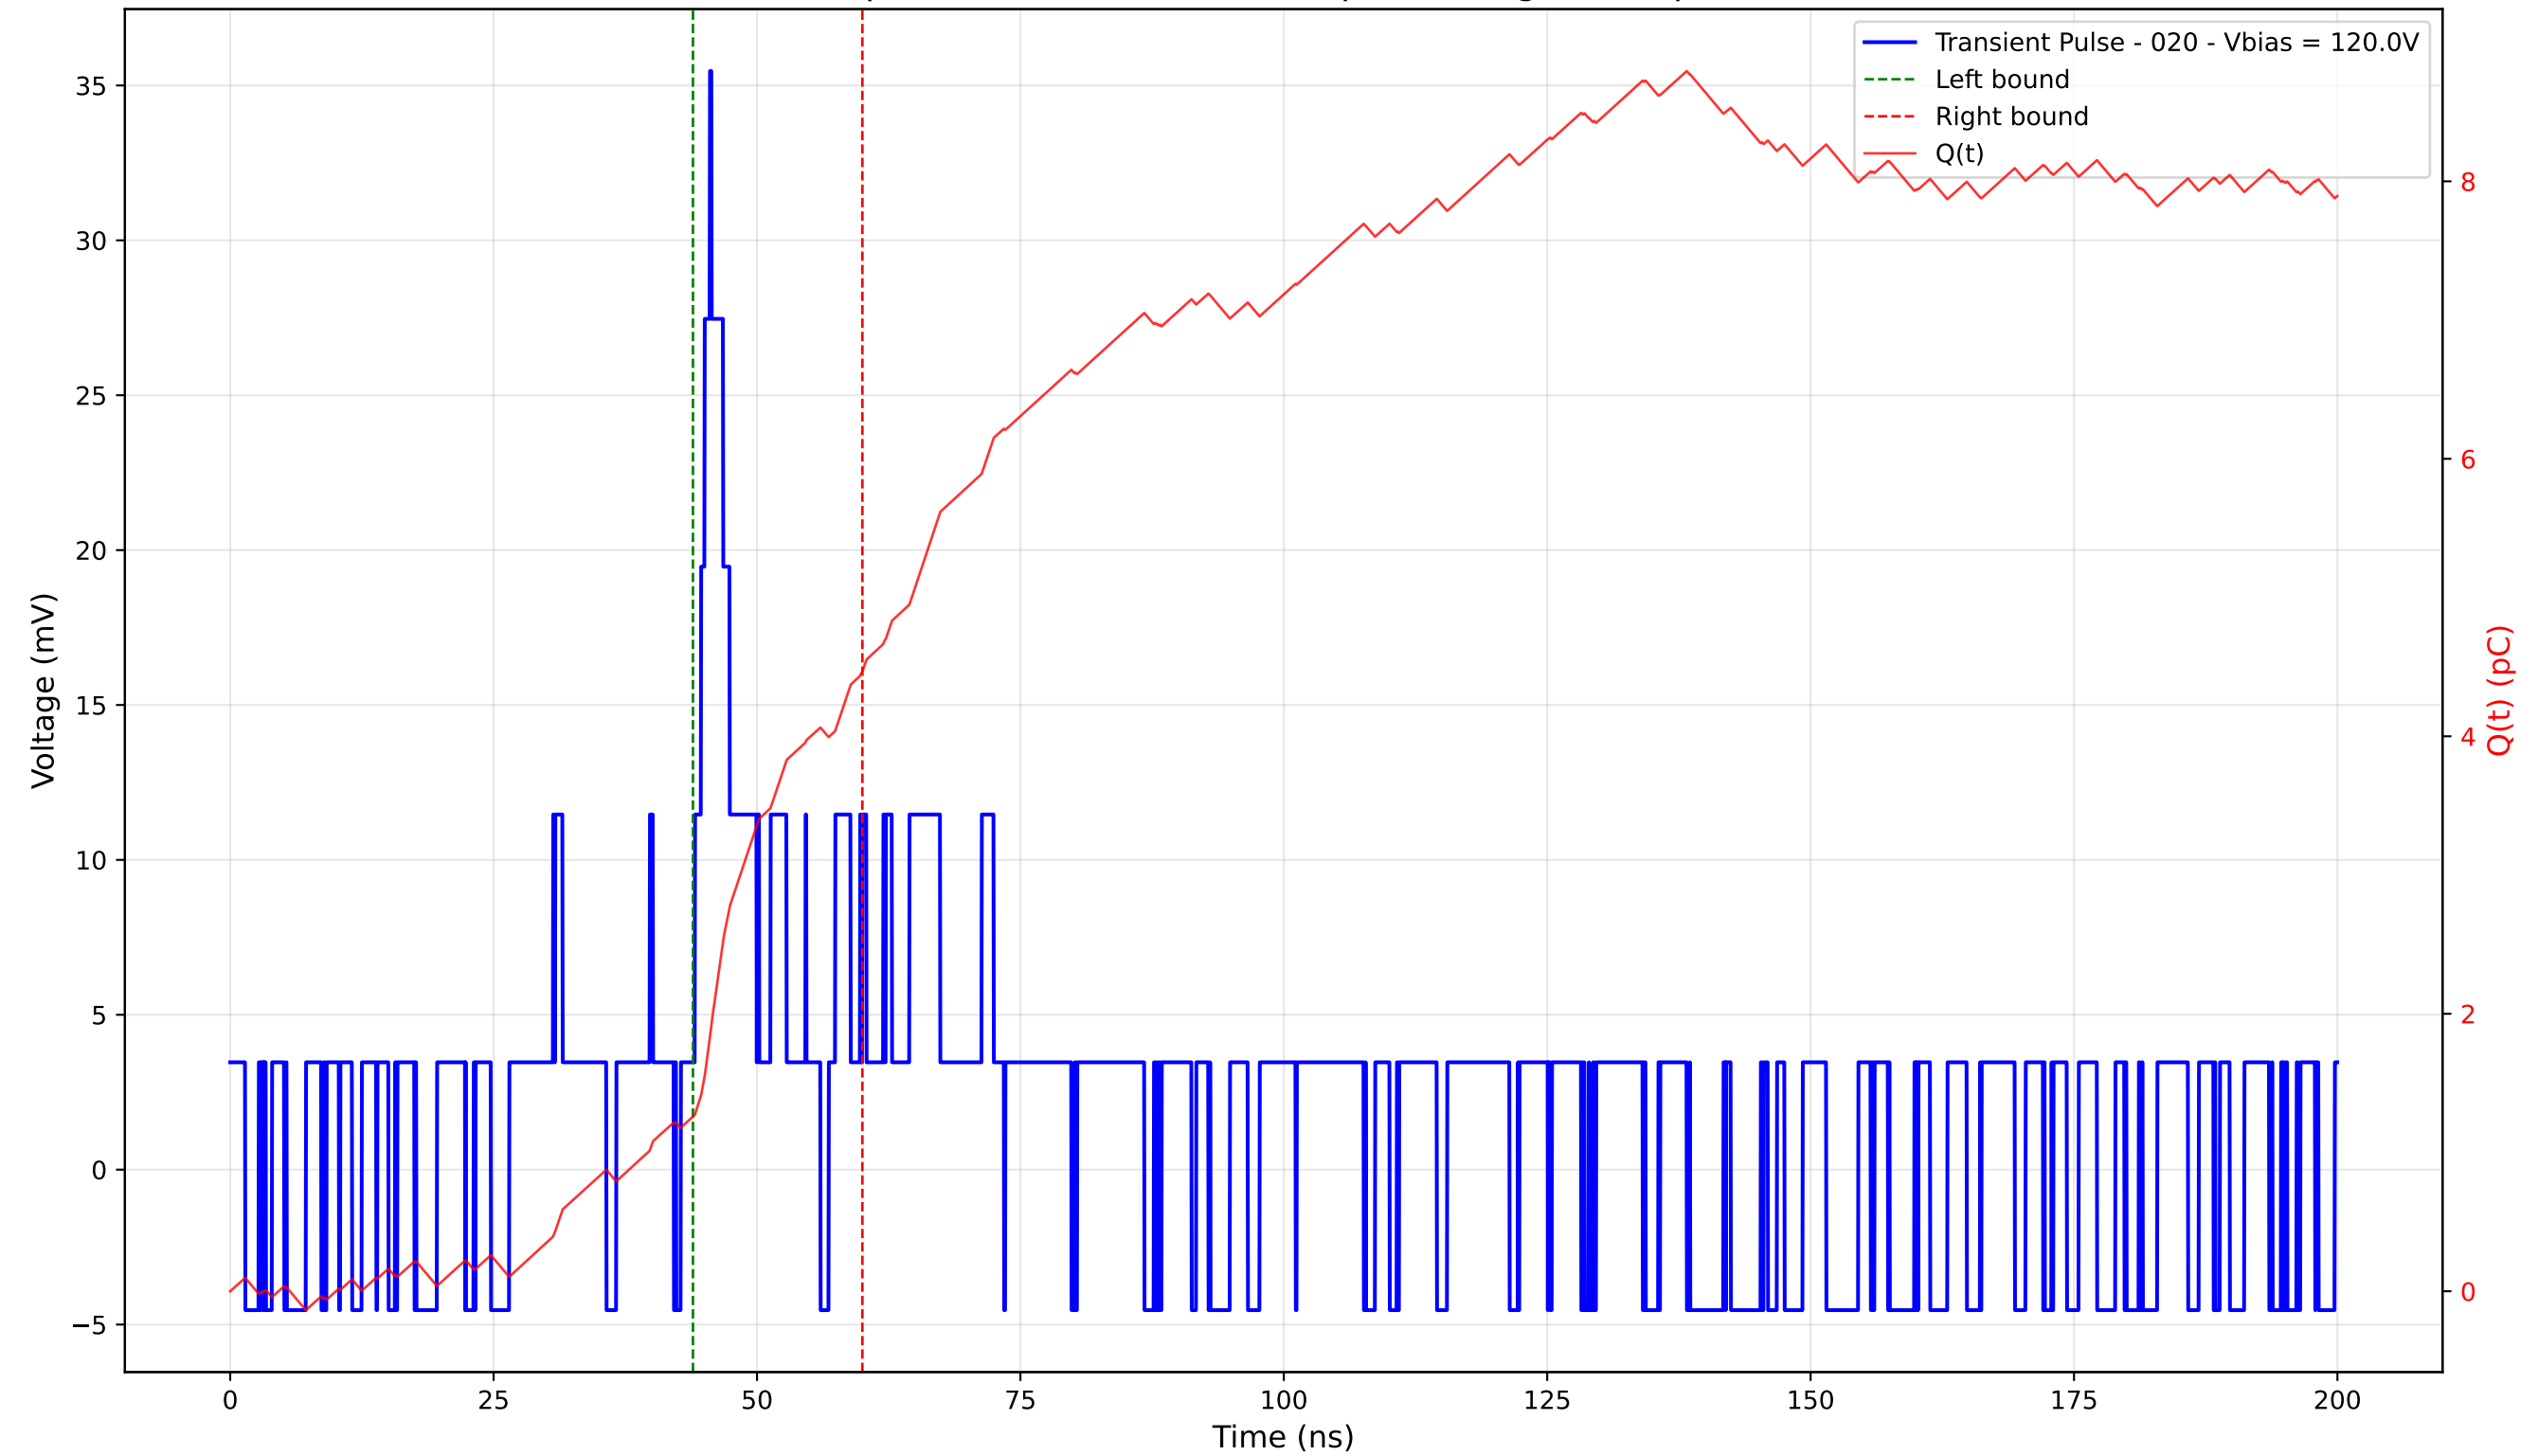


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 3.40 pC - Rise Time: 0.98 ns

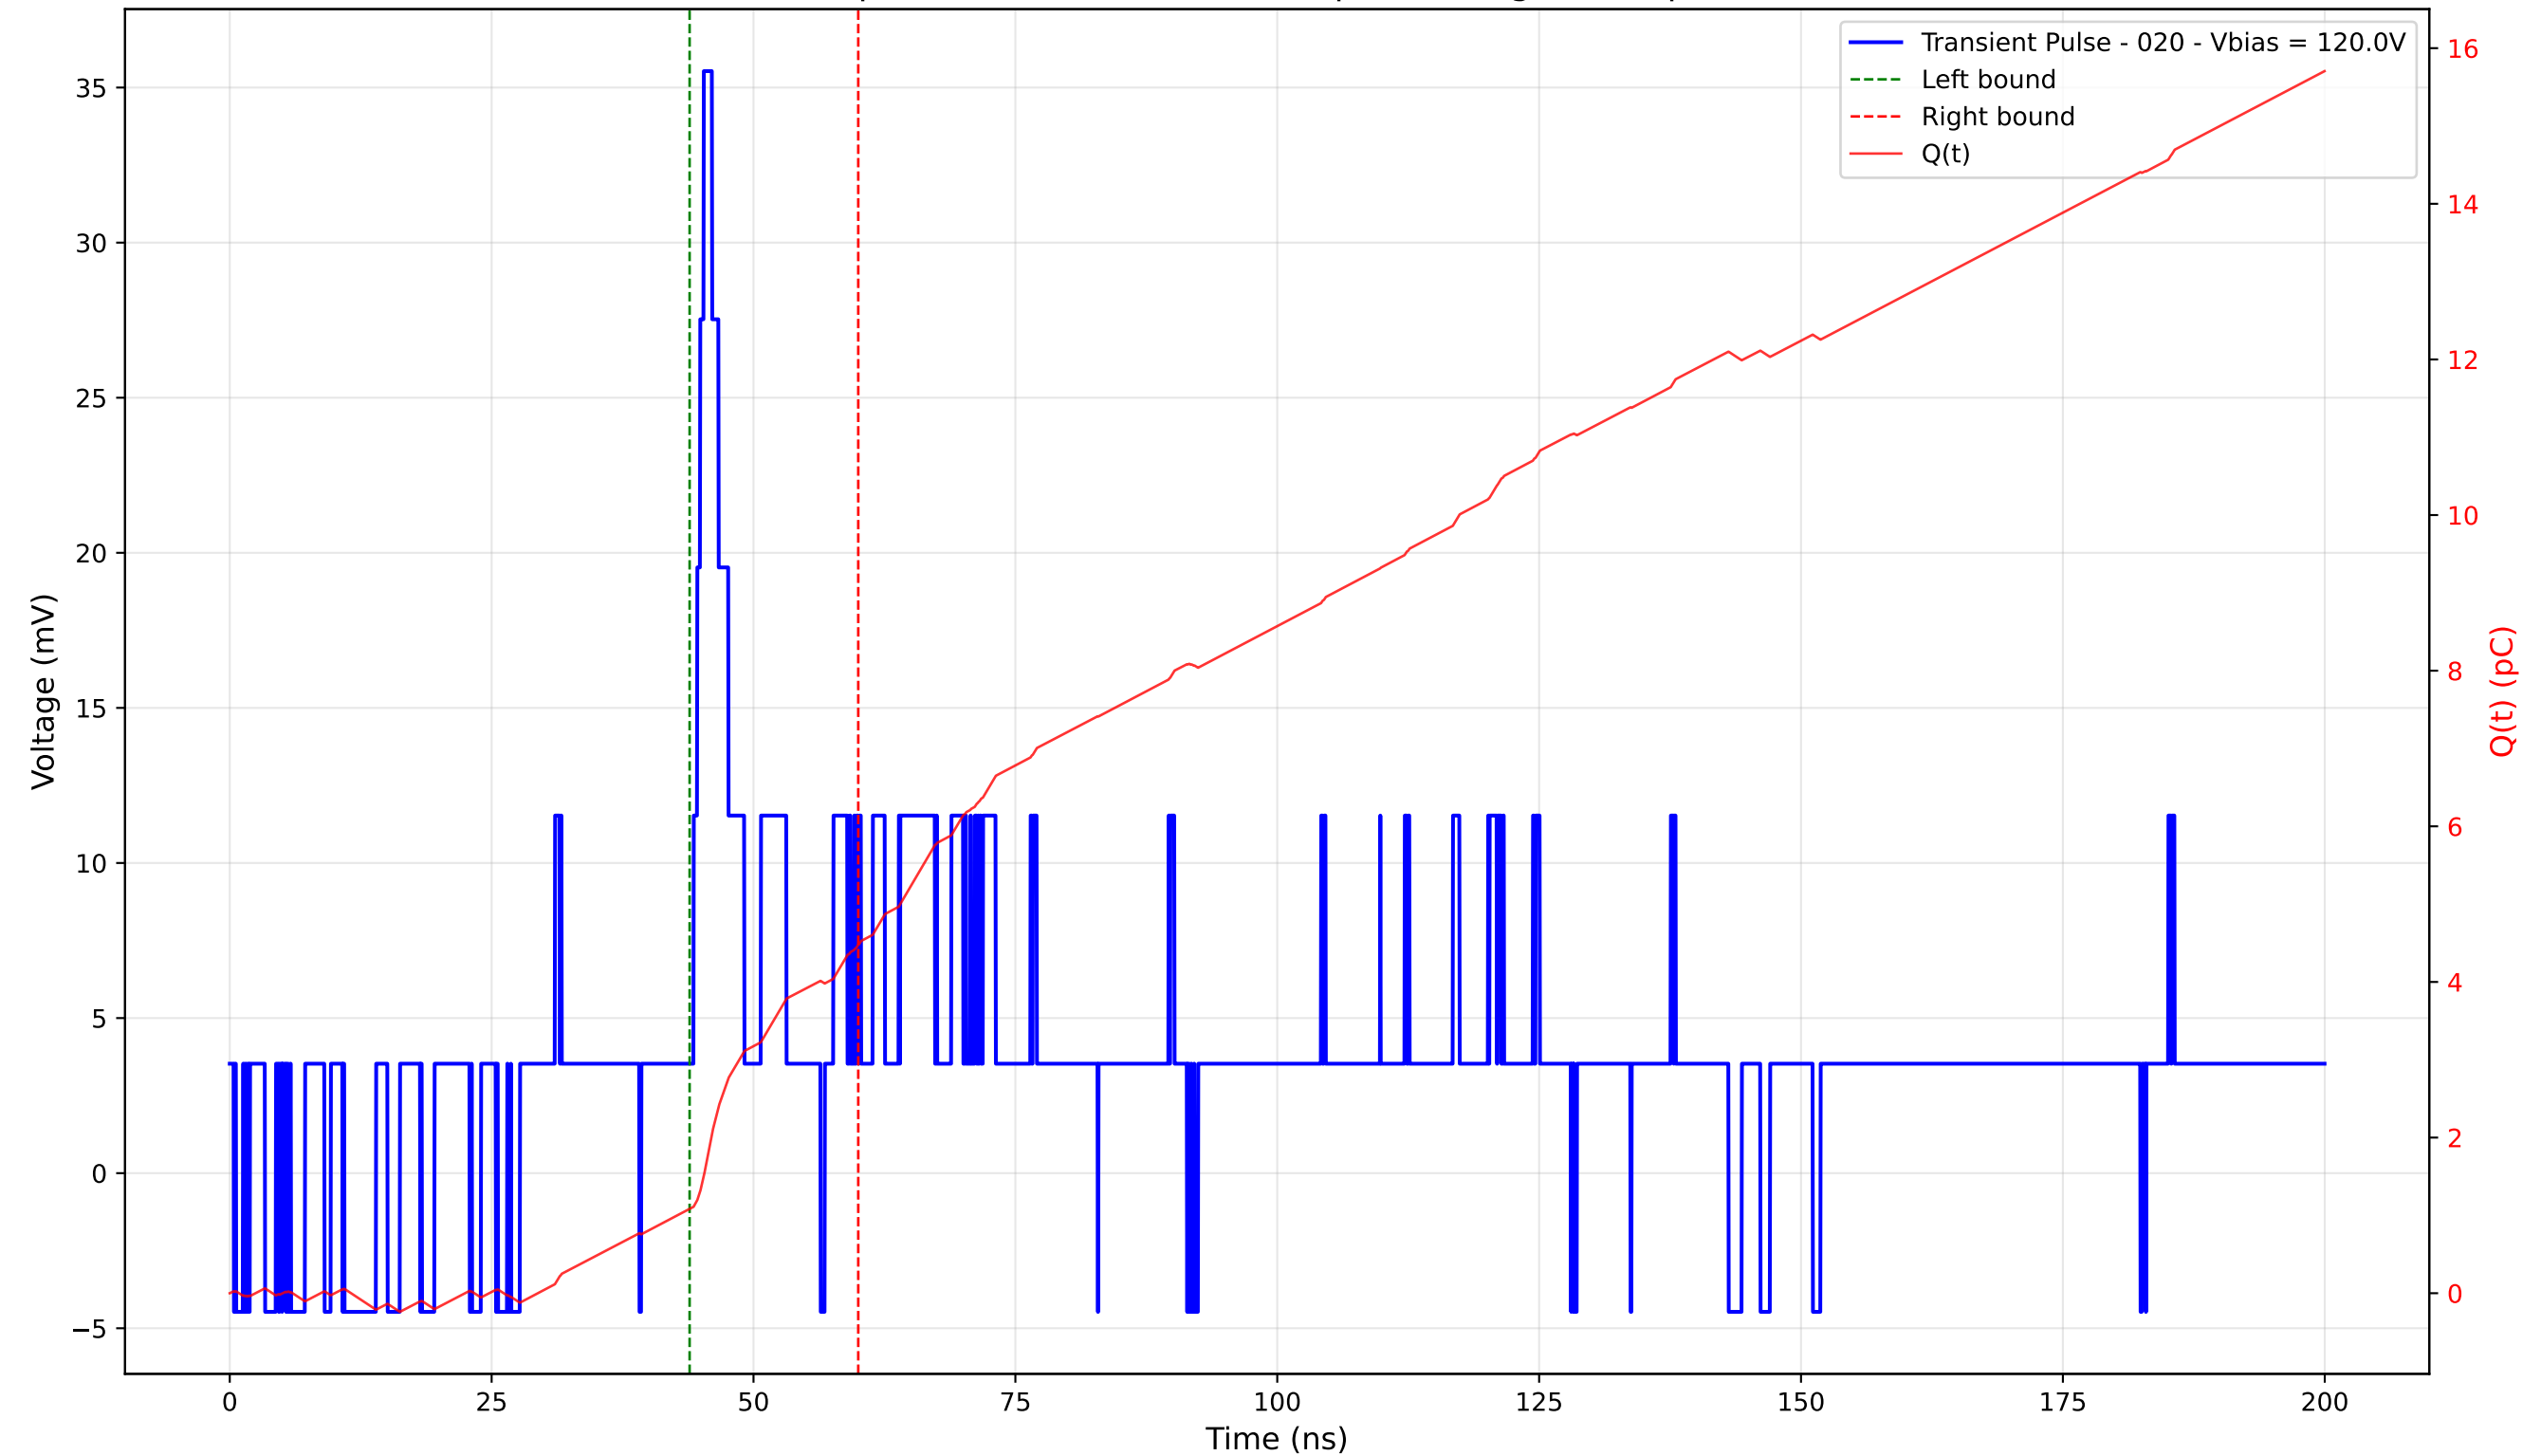


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 2.93 pC - Rise Time: 0.00 ns (N/A)

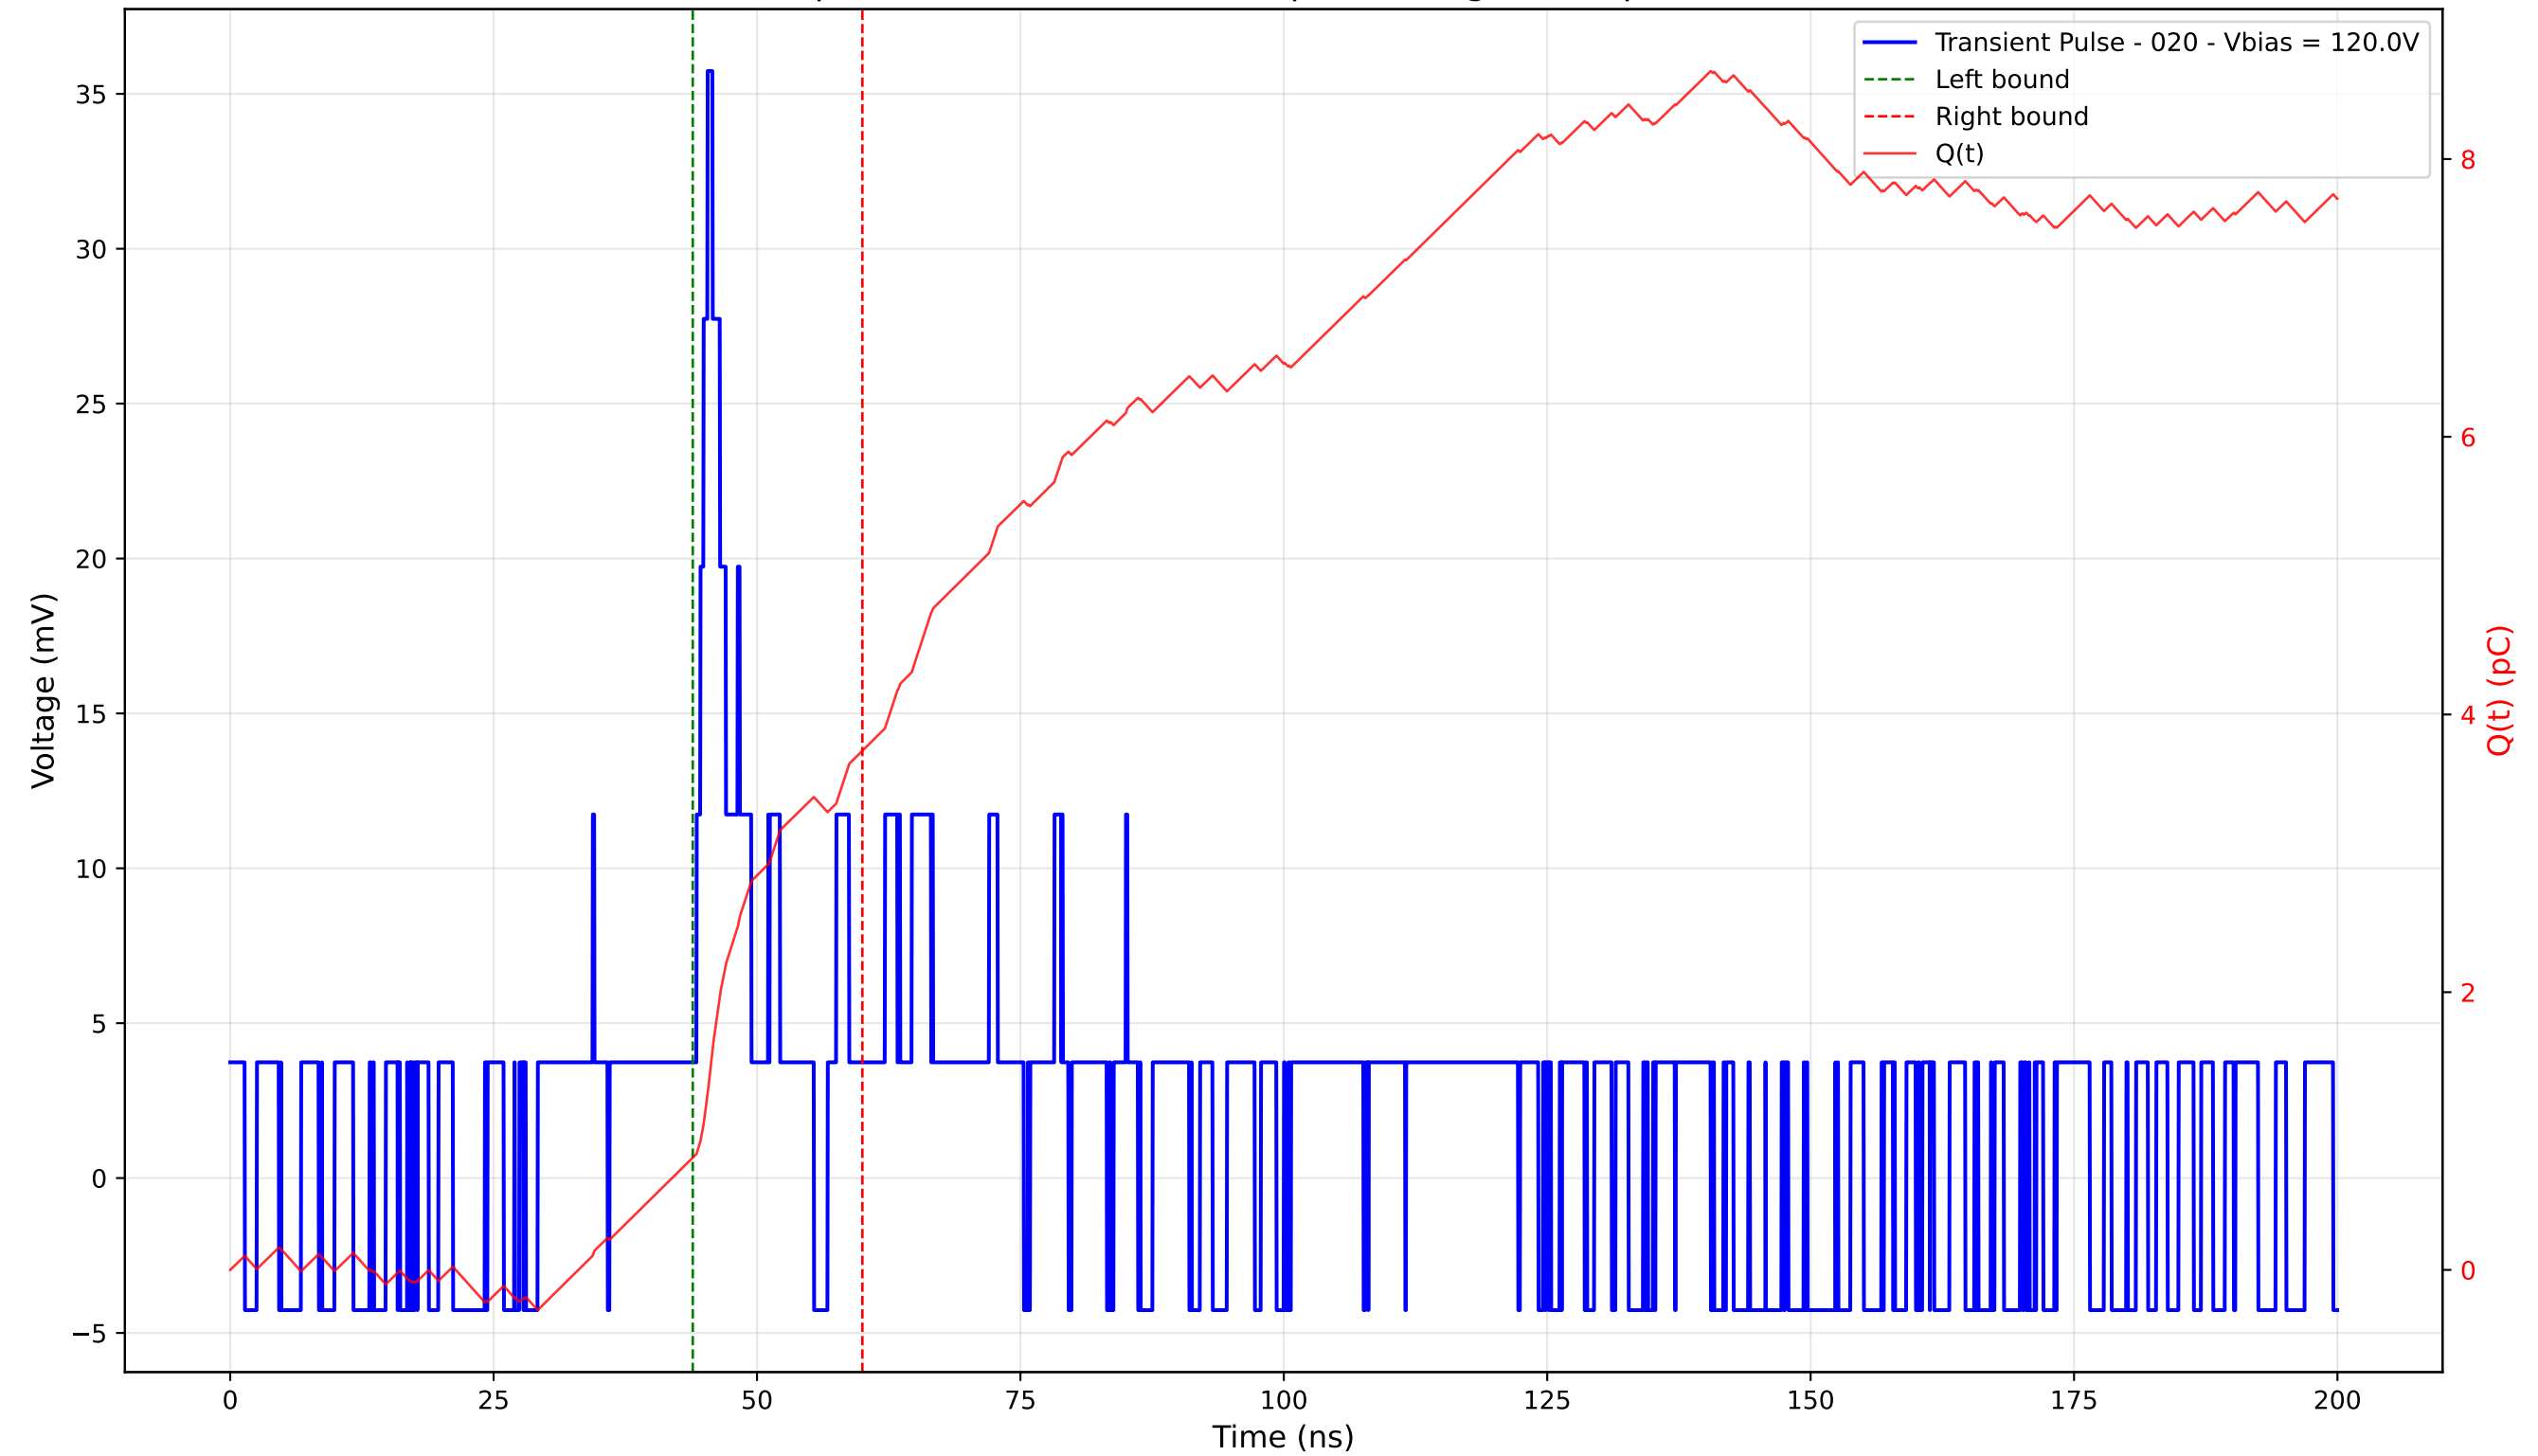


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.23 pC - Rise Time: 1.91 ns

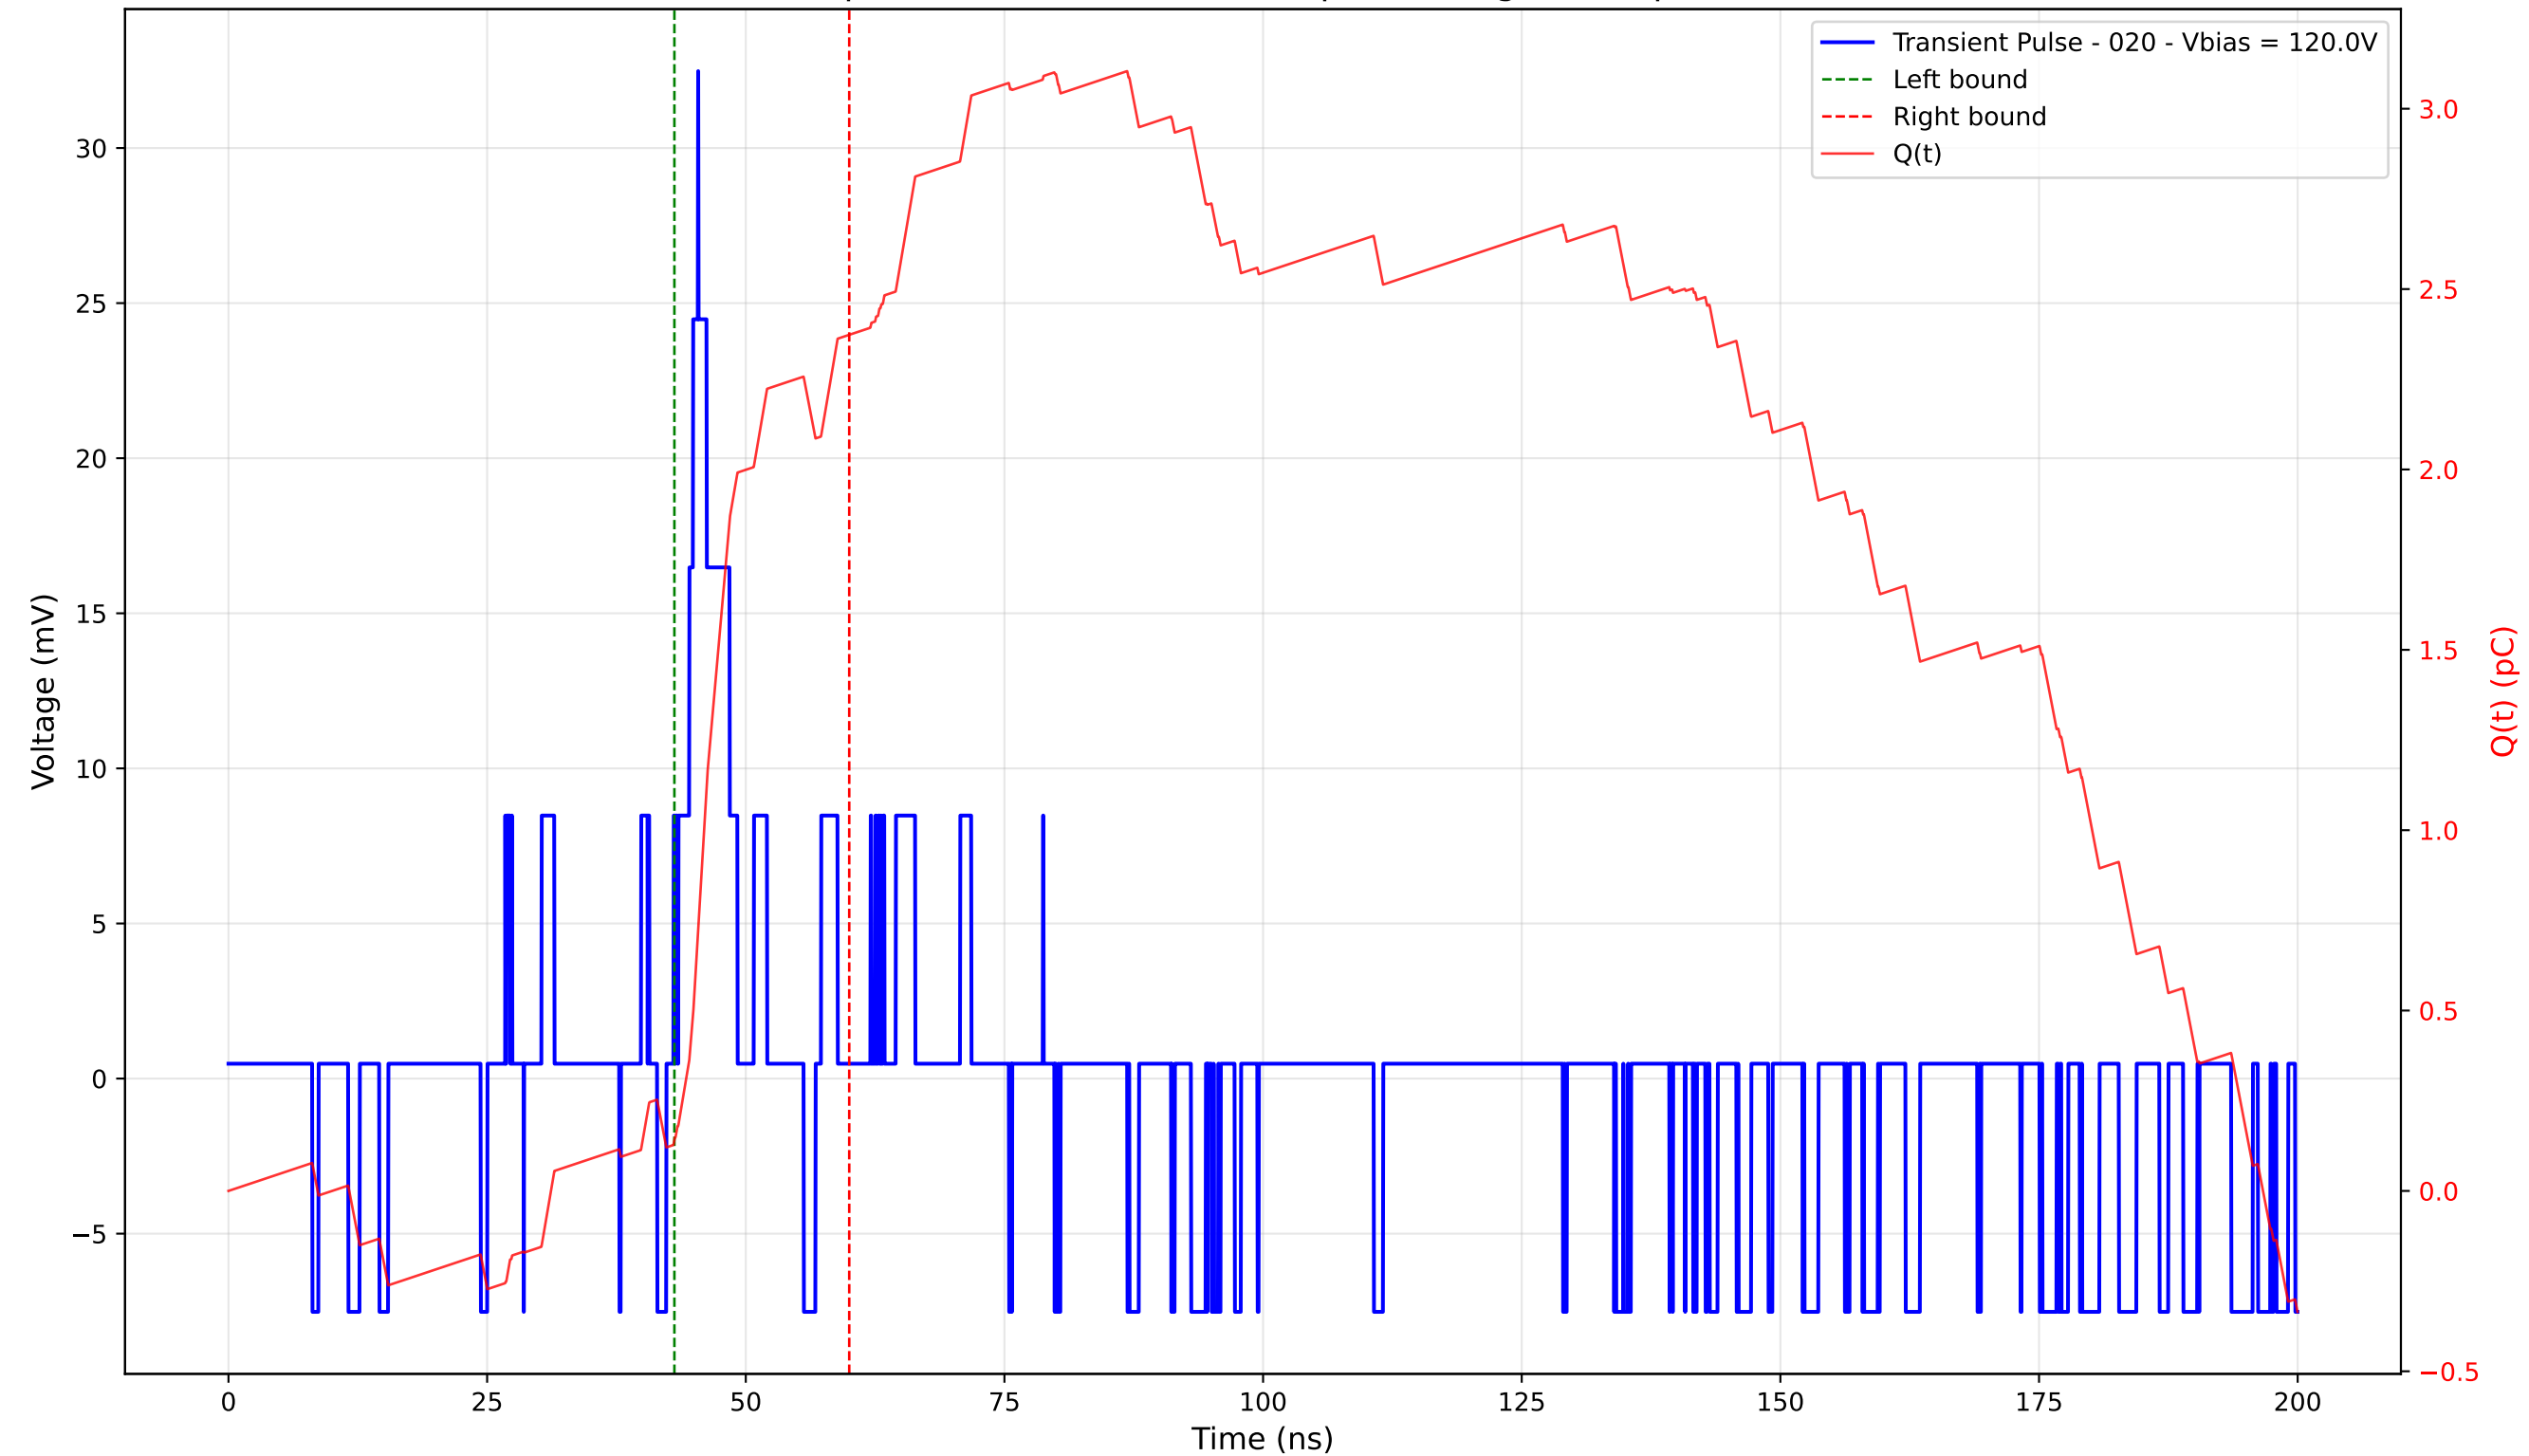


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 2.86 pC - Rise Time: 1.16 ns

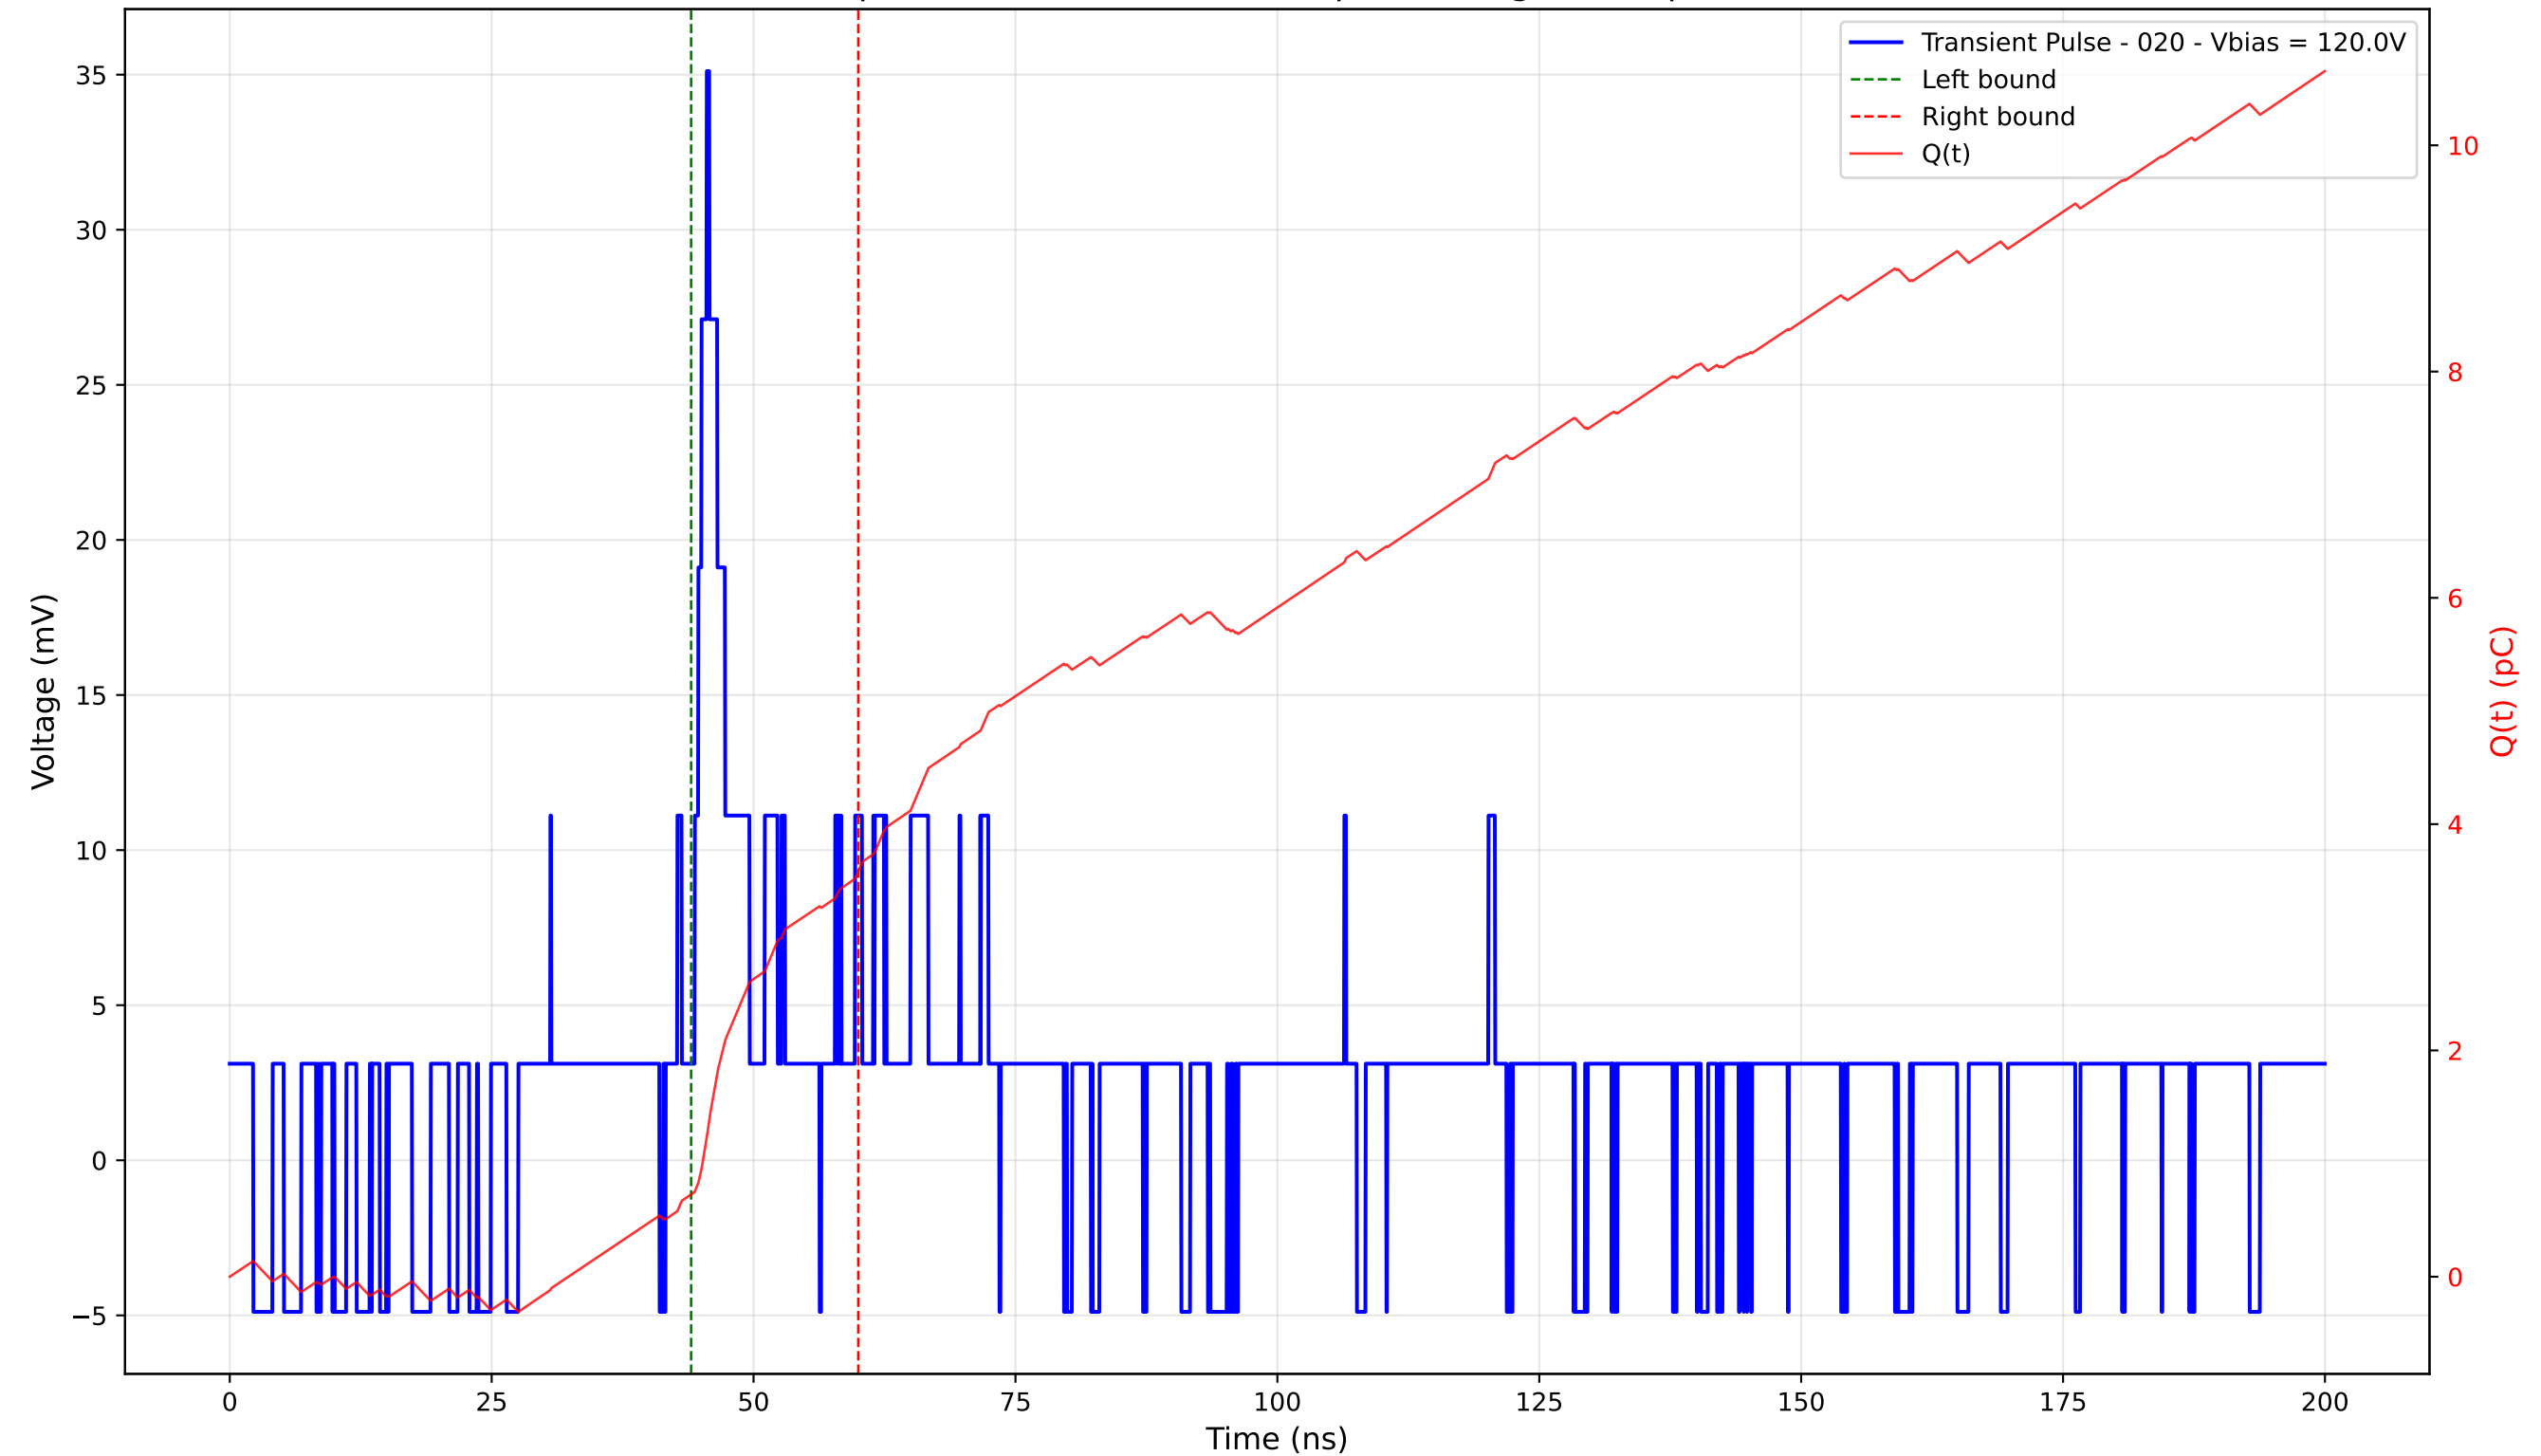


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 3.85 pC - Rise Time: 5.57 ns

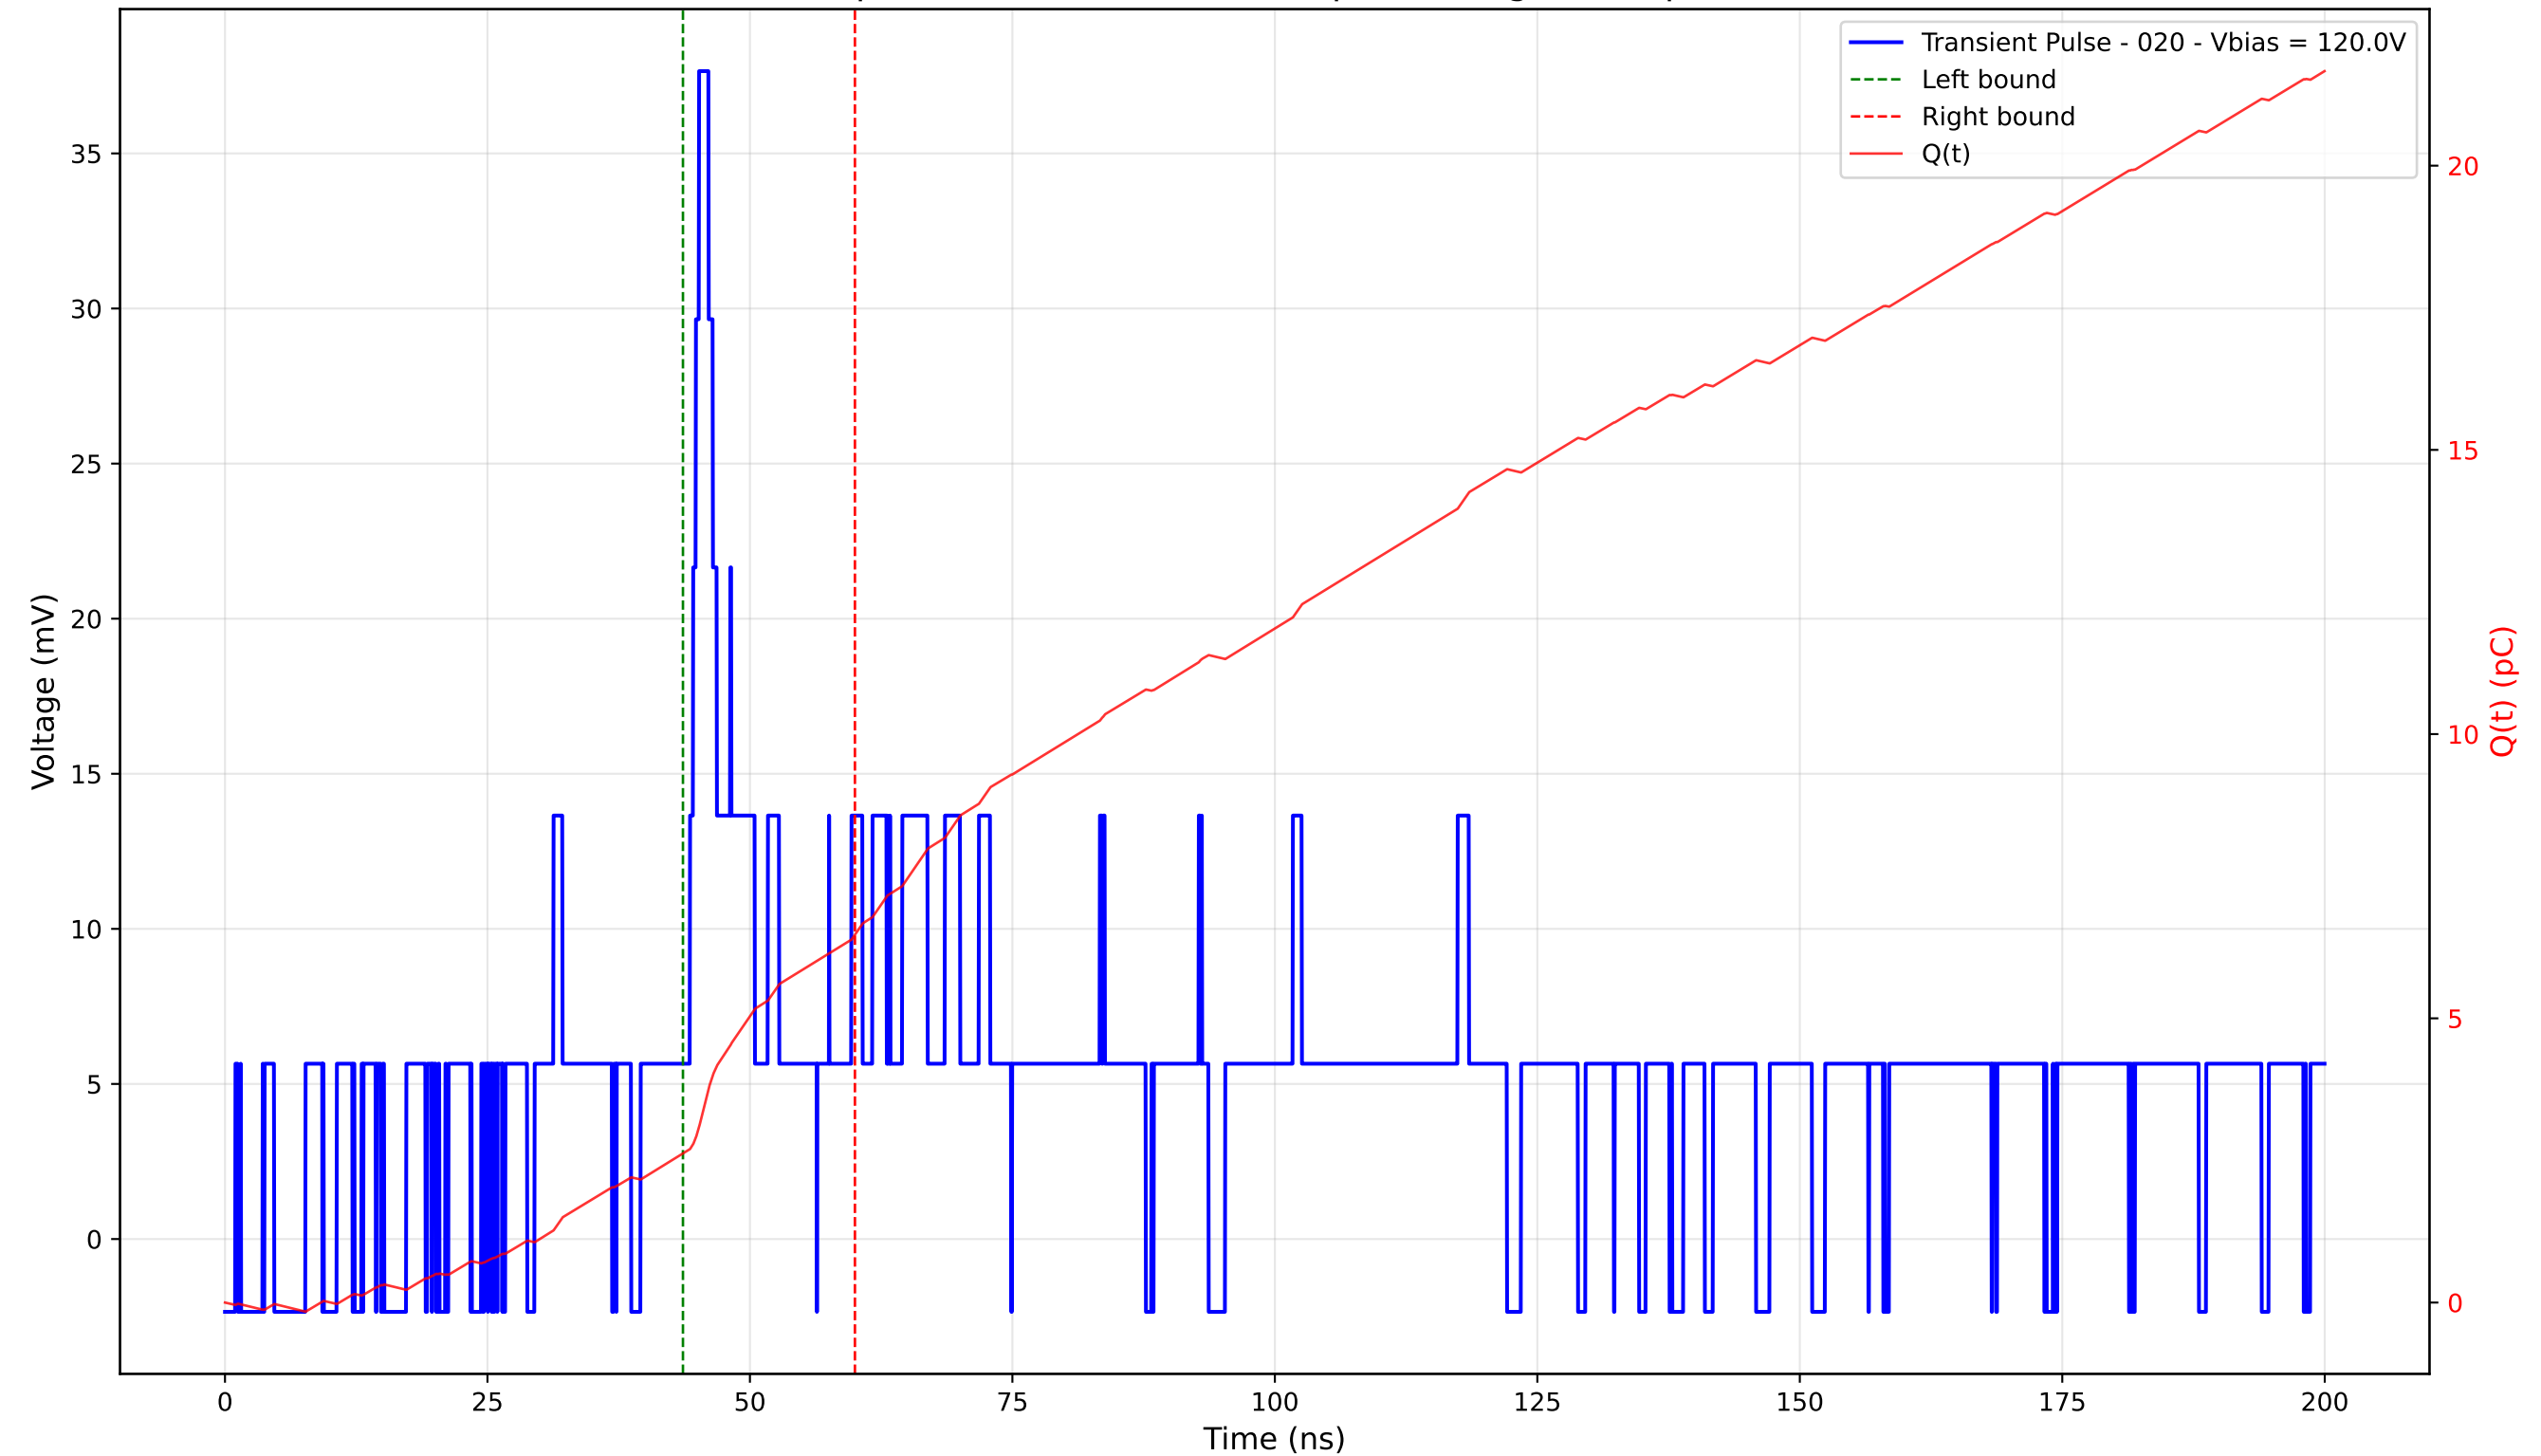


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 4.00 pC - Rise Time: 1.46 ns

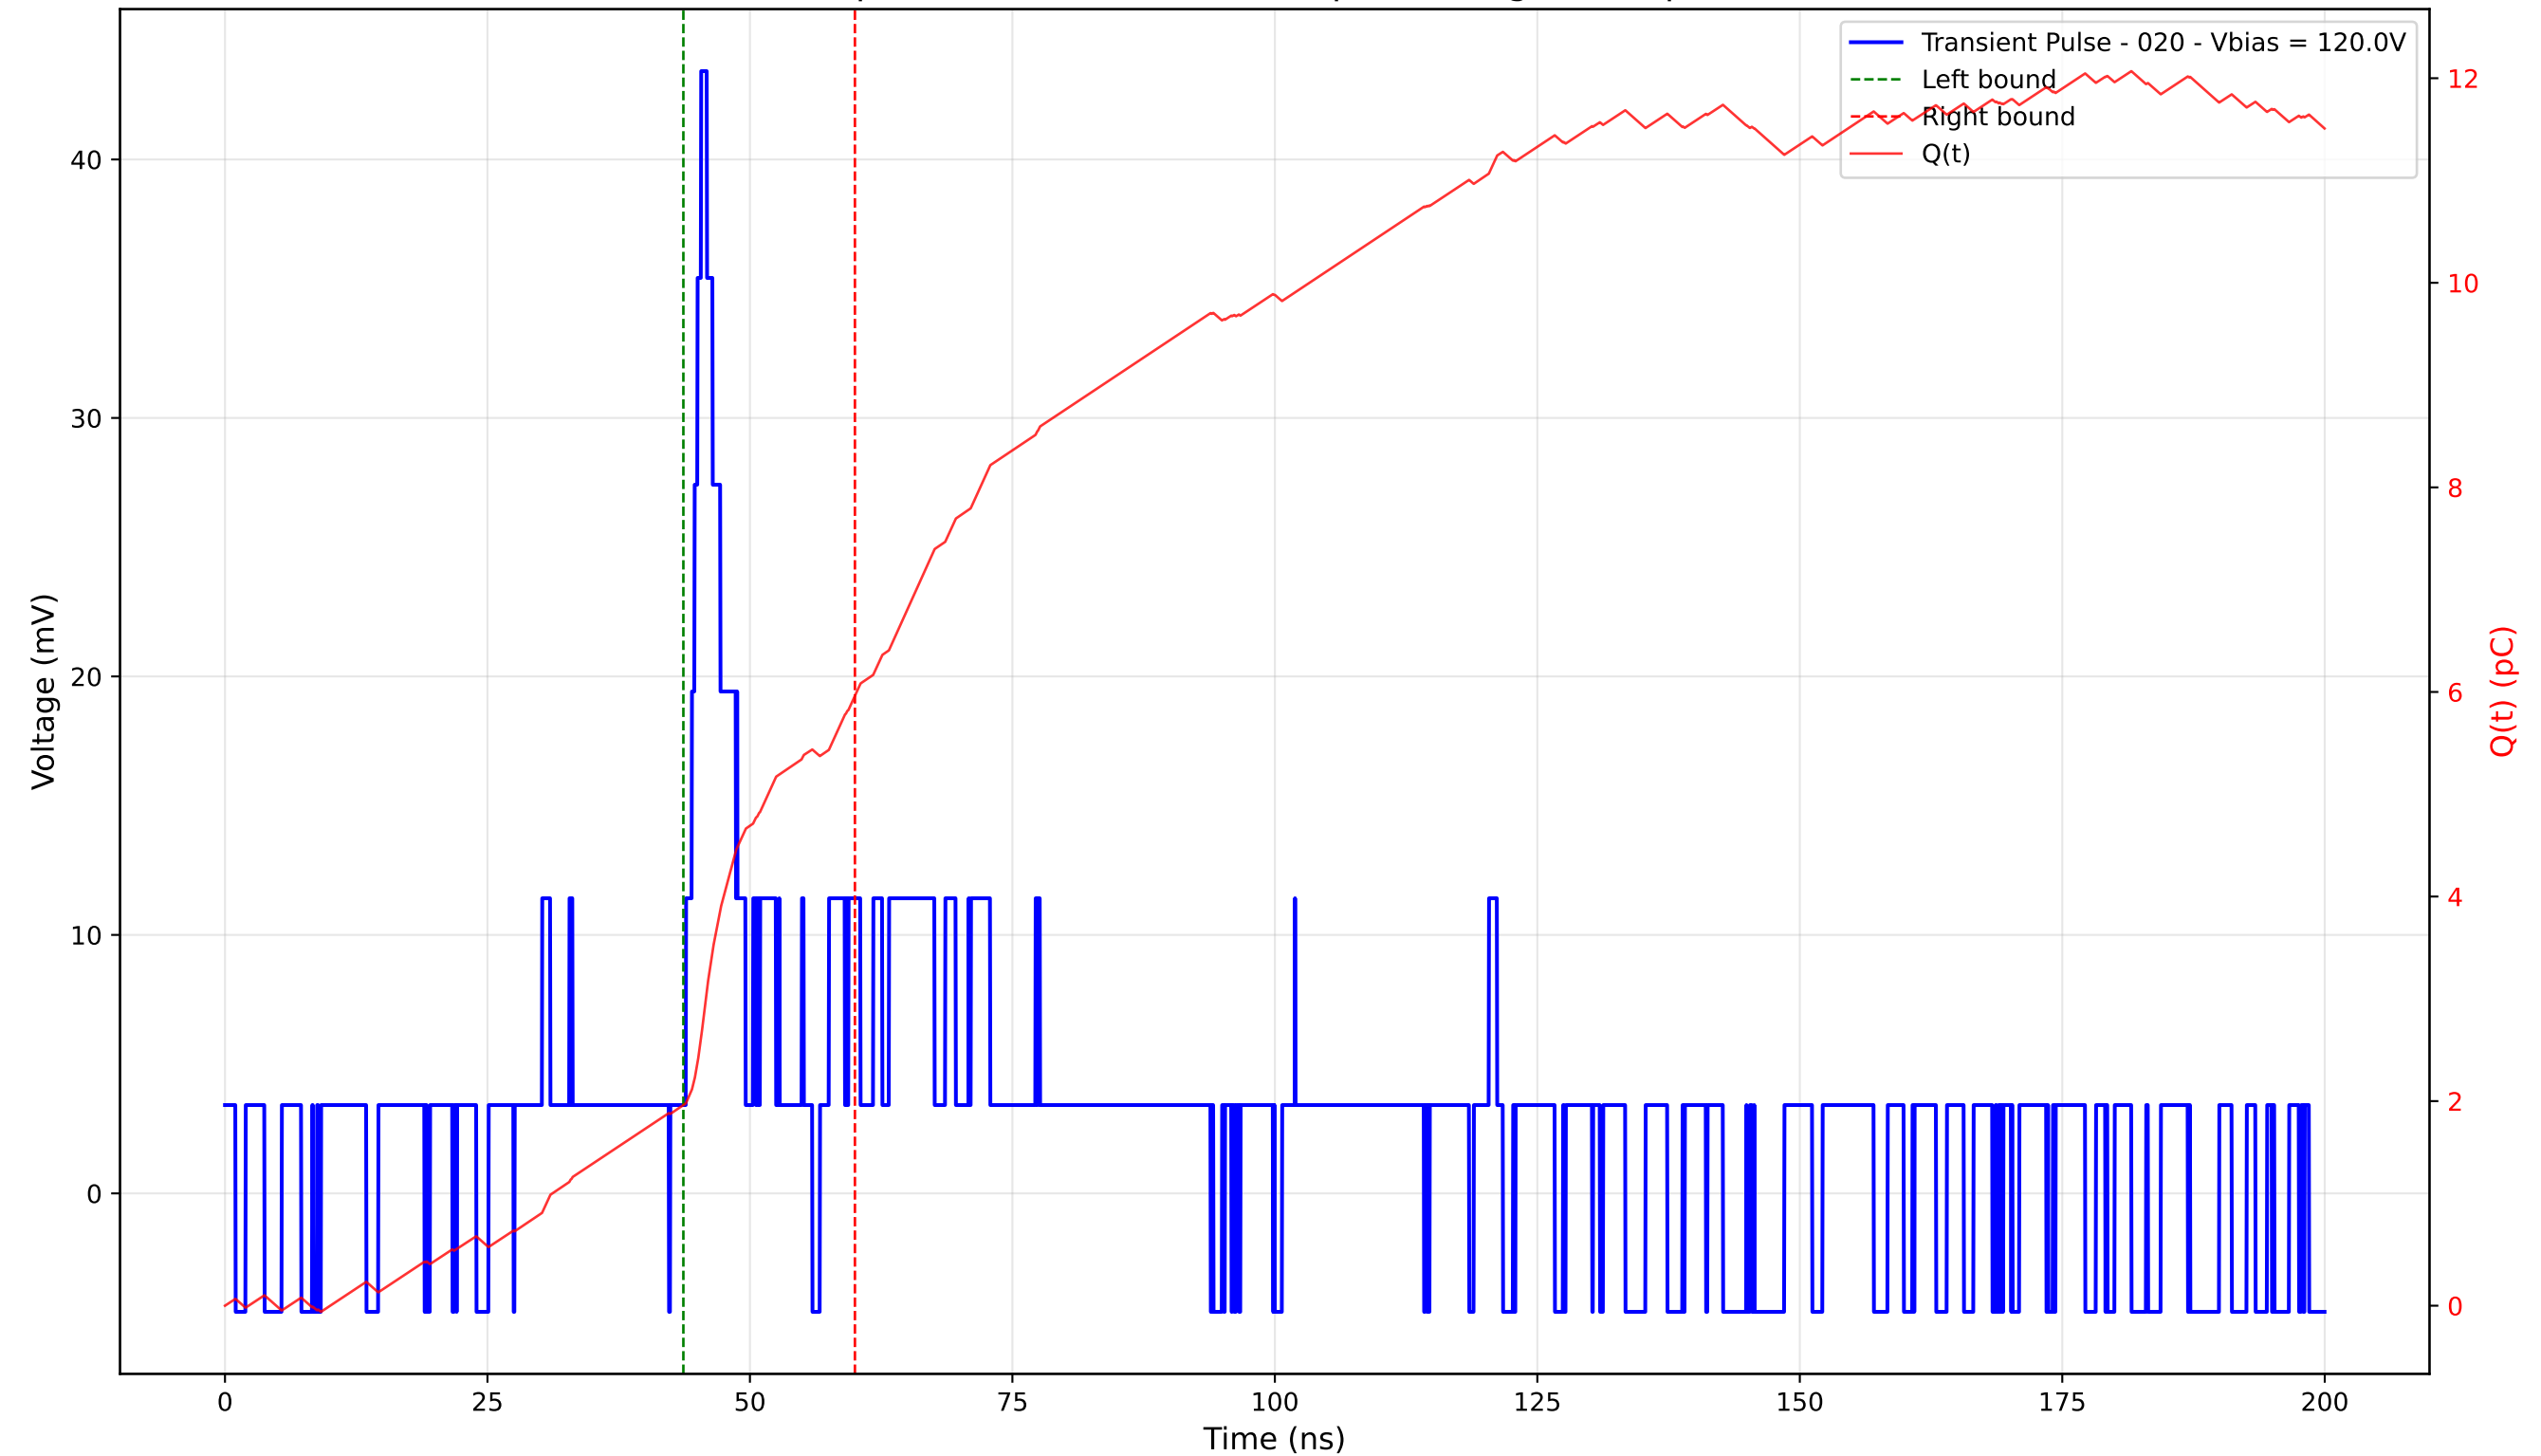


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 3.55 pC - Rise Time: 1.18 ns

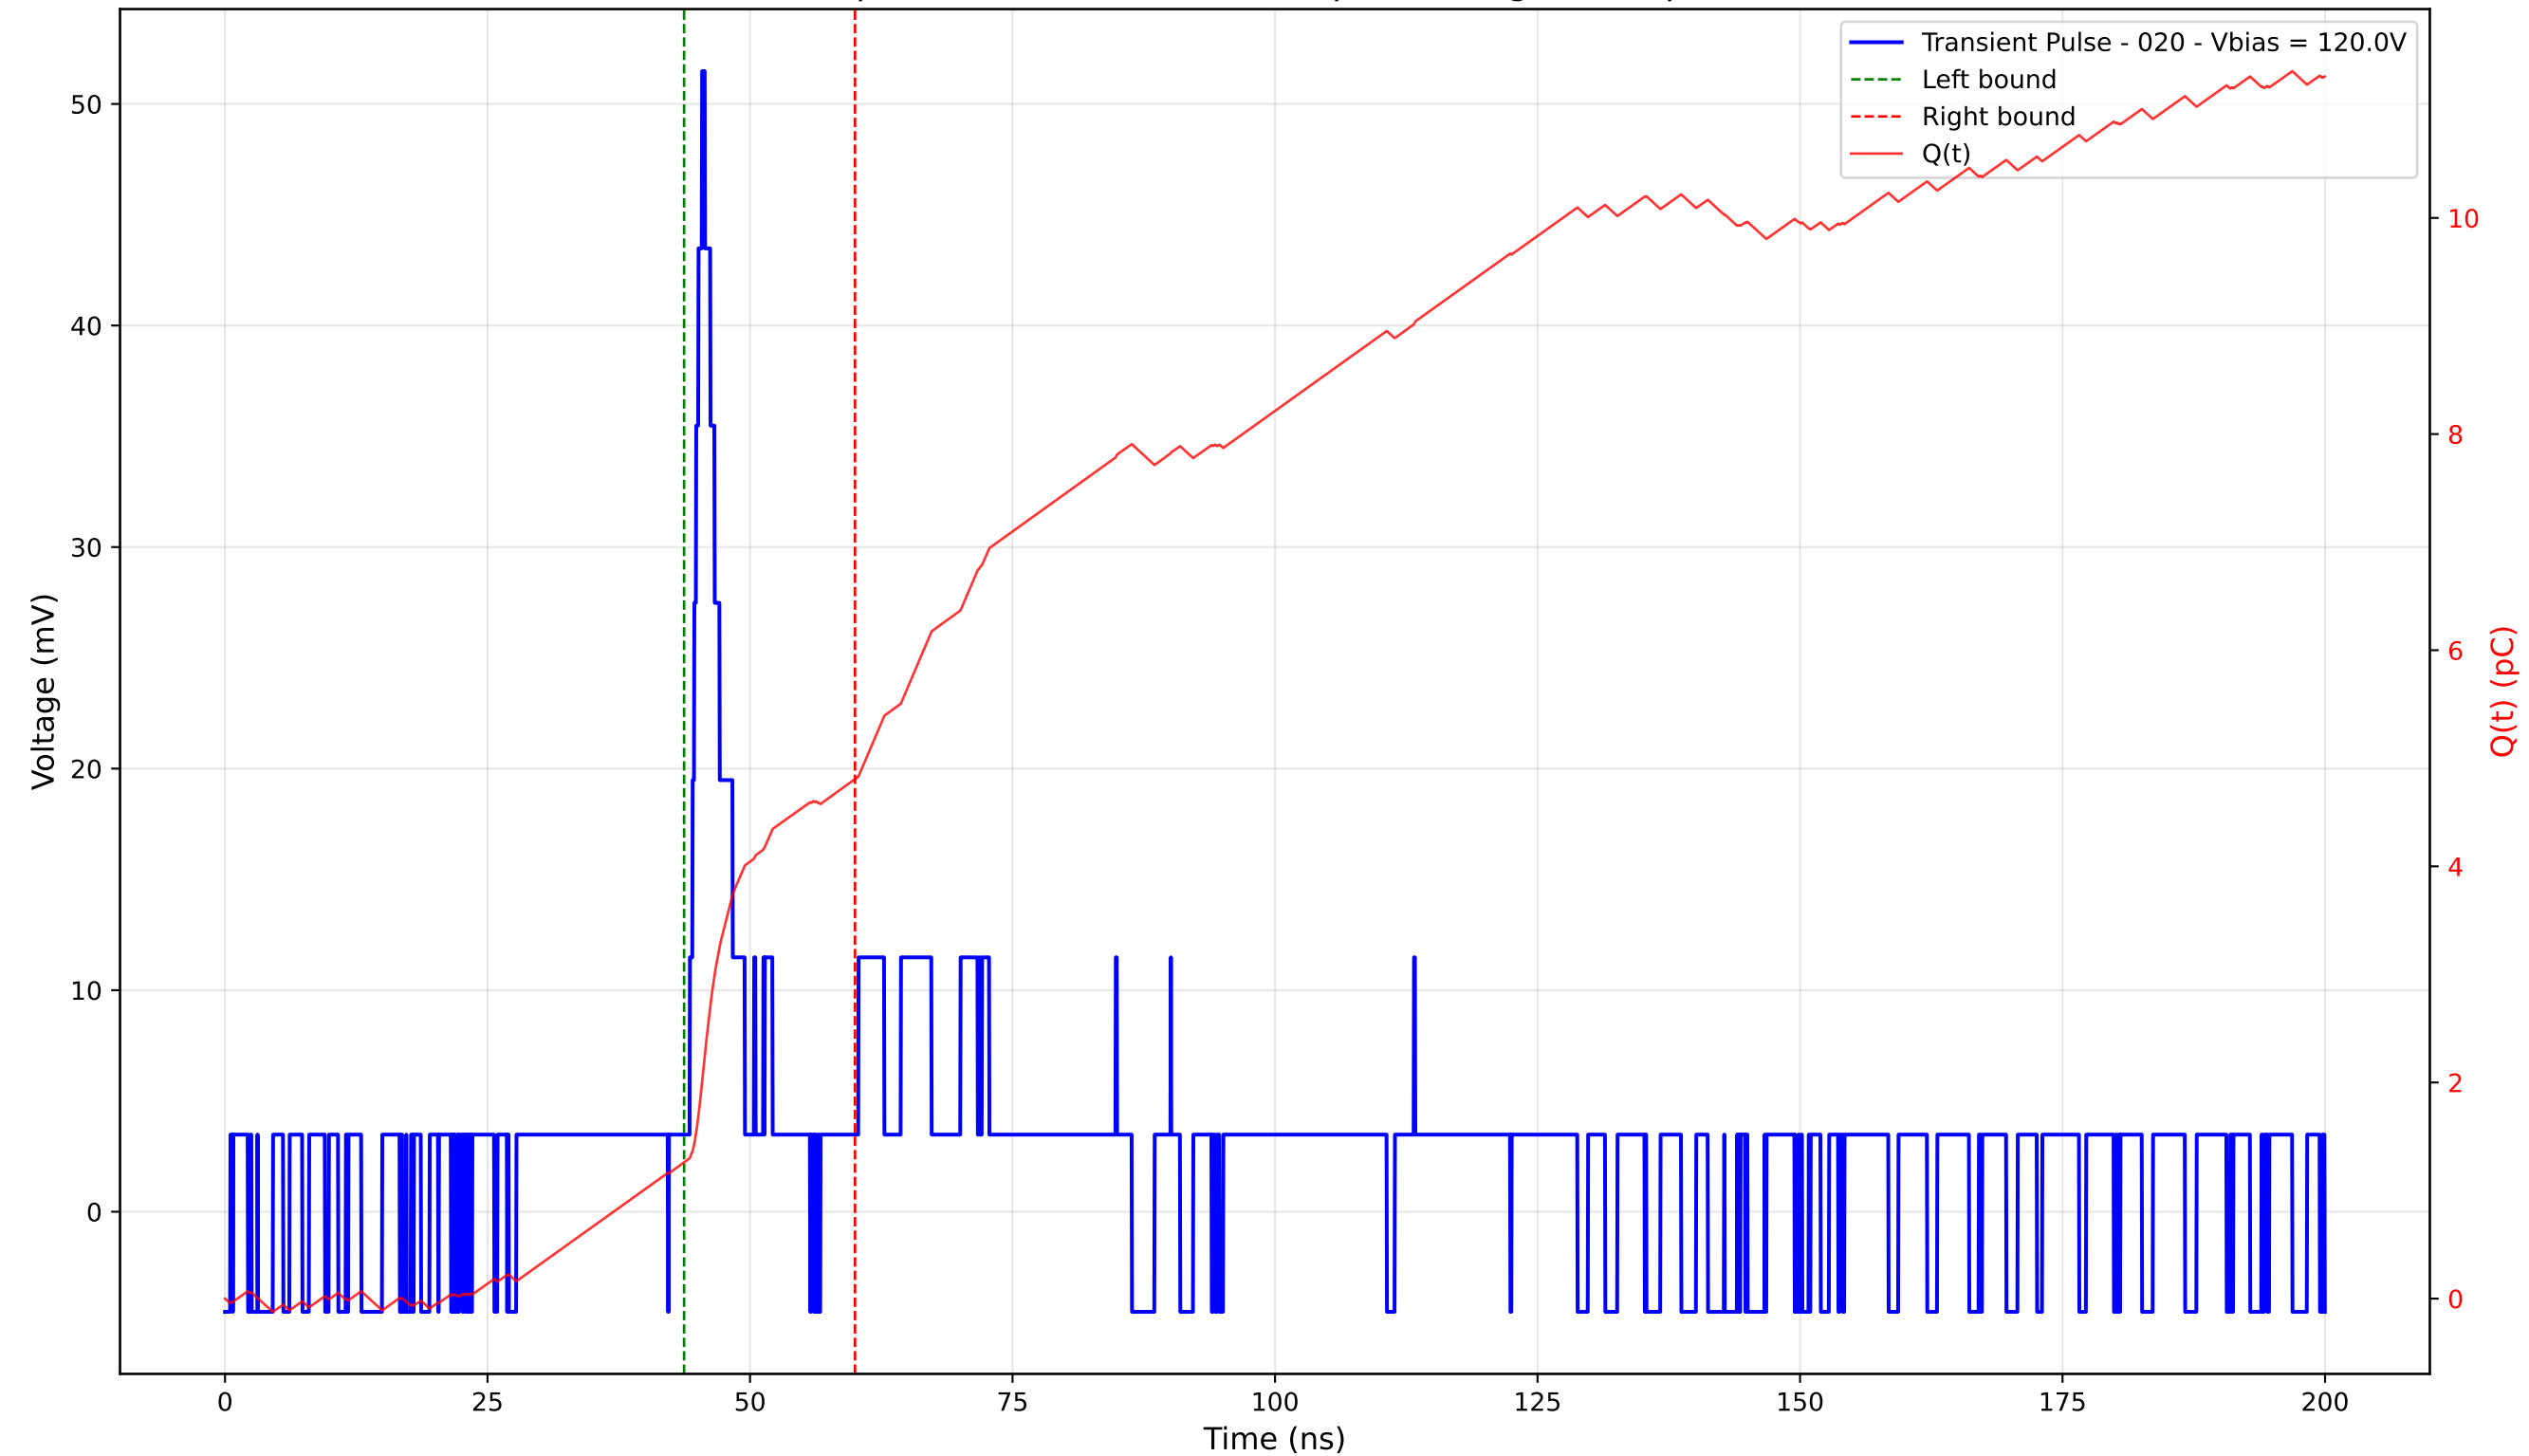


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 4.02 pC - Rise Time: 2.81 ns

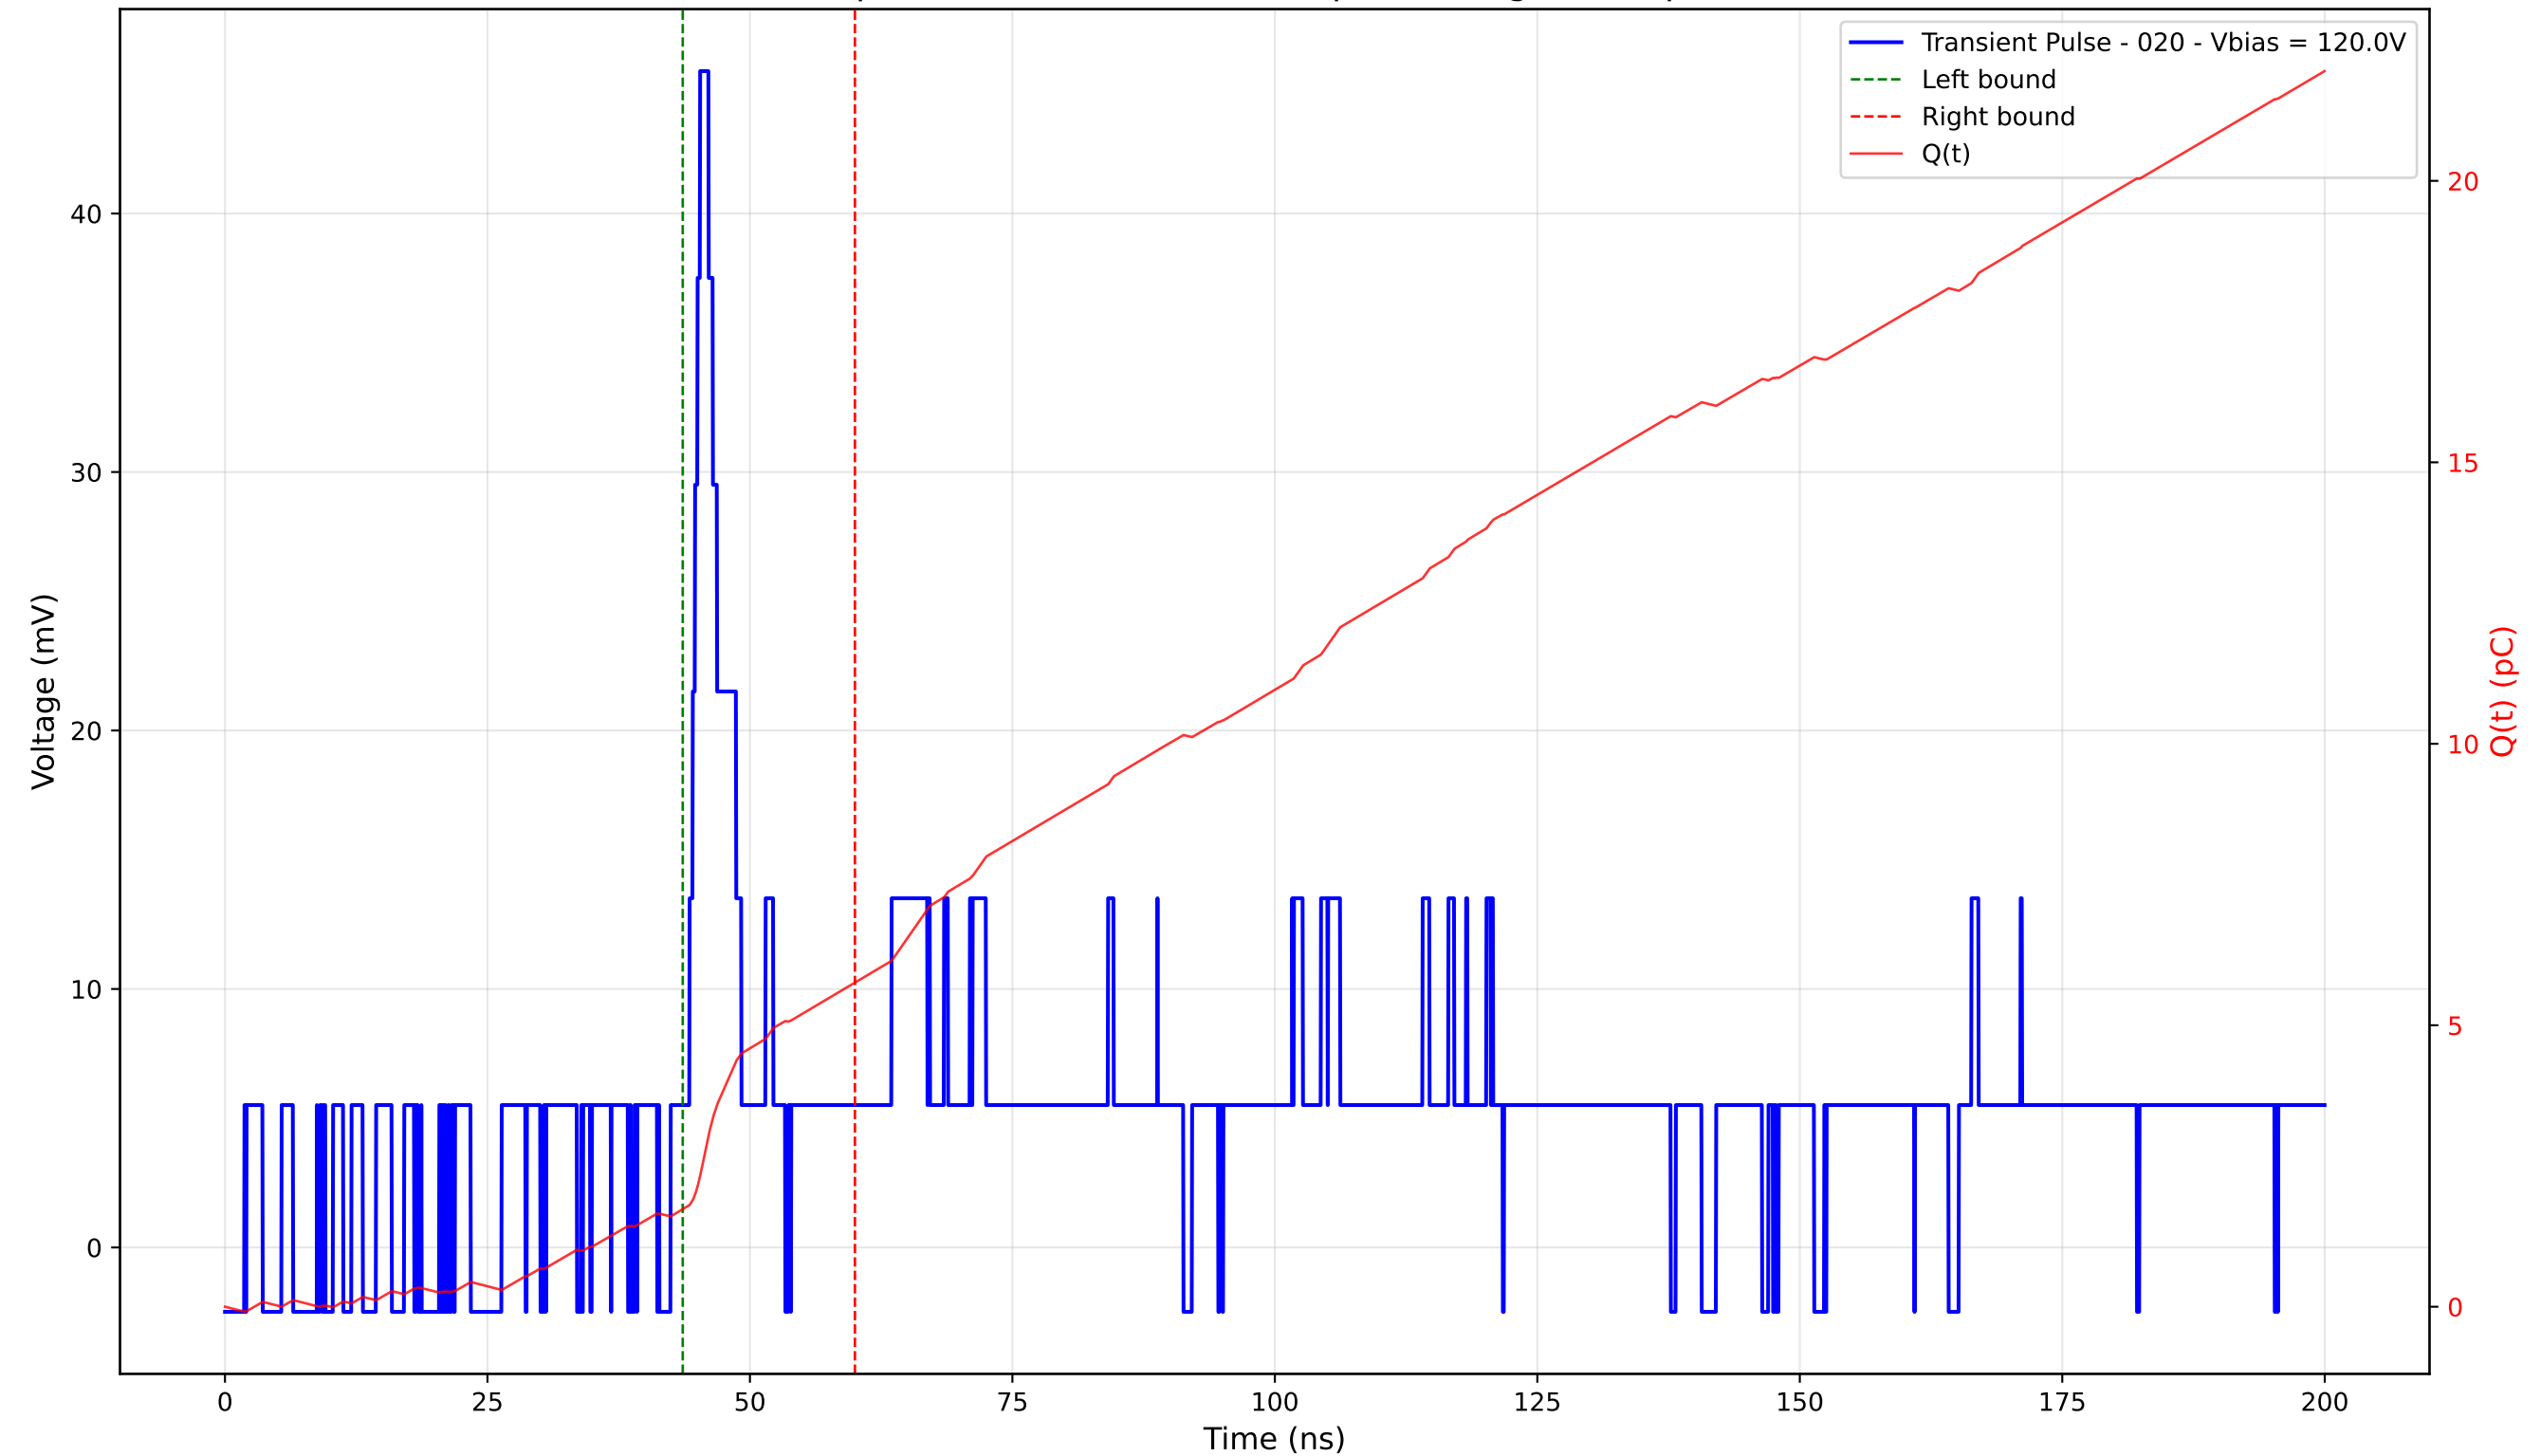


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 2.90 pC - Rise Time: 0.99 ns

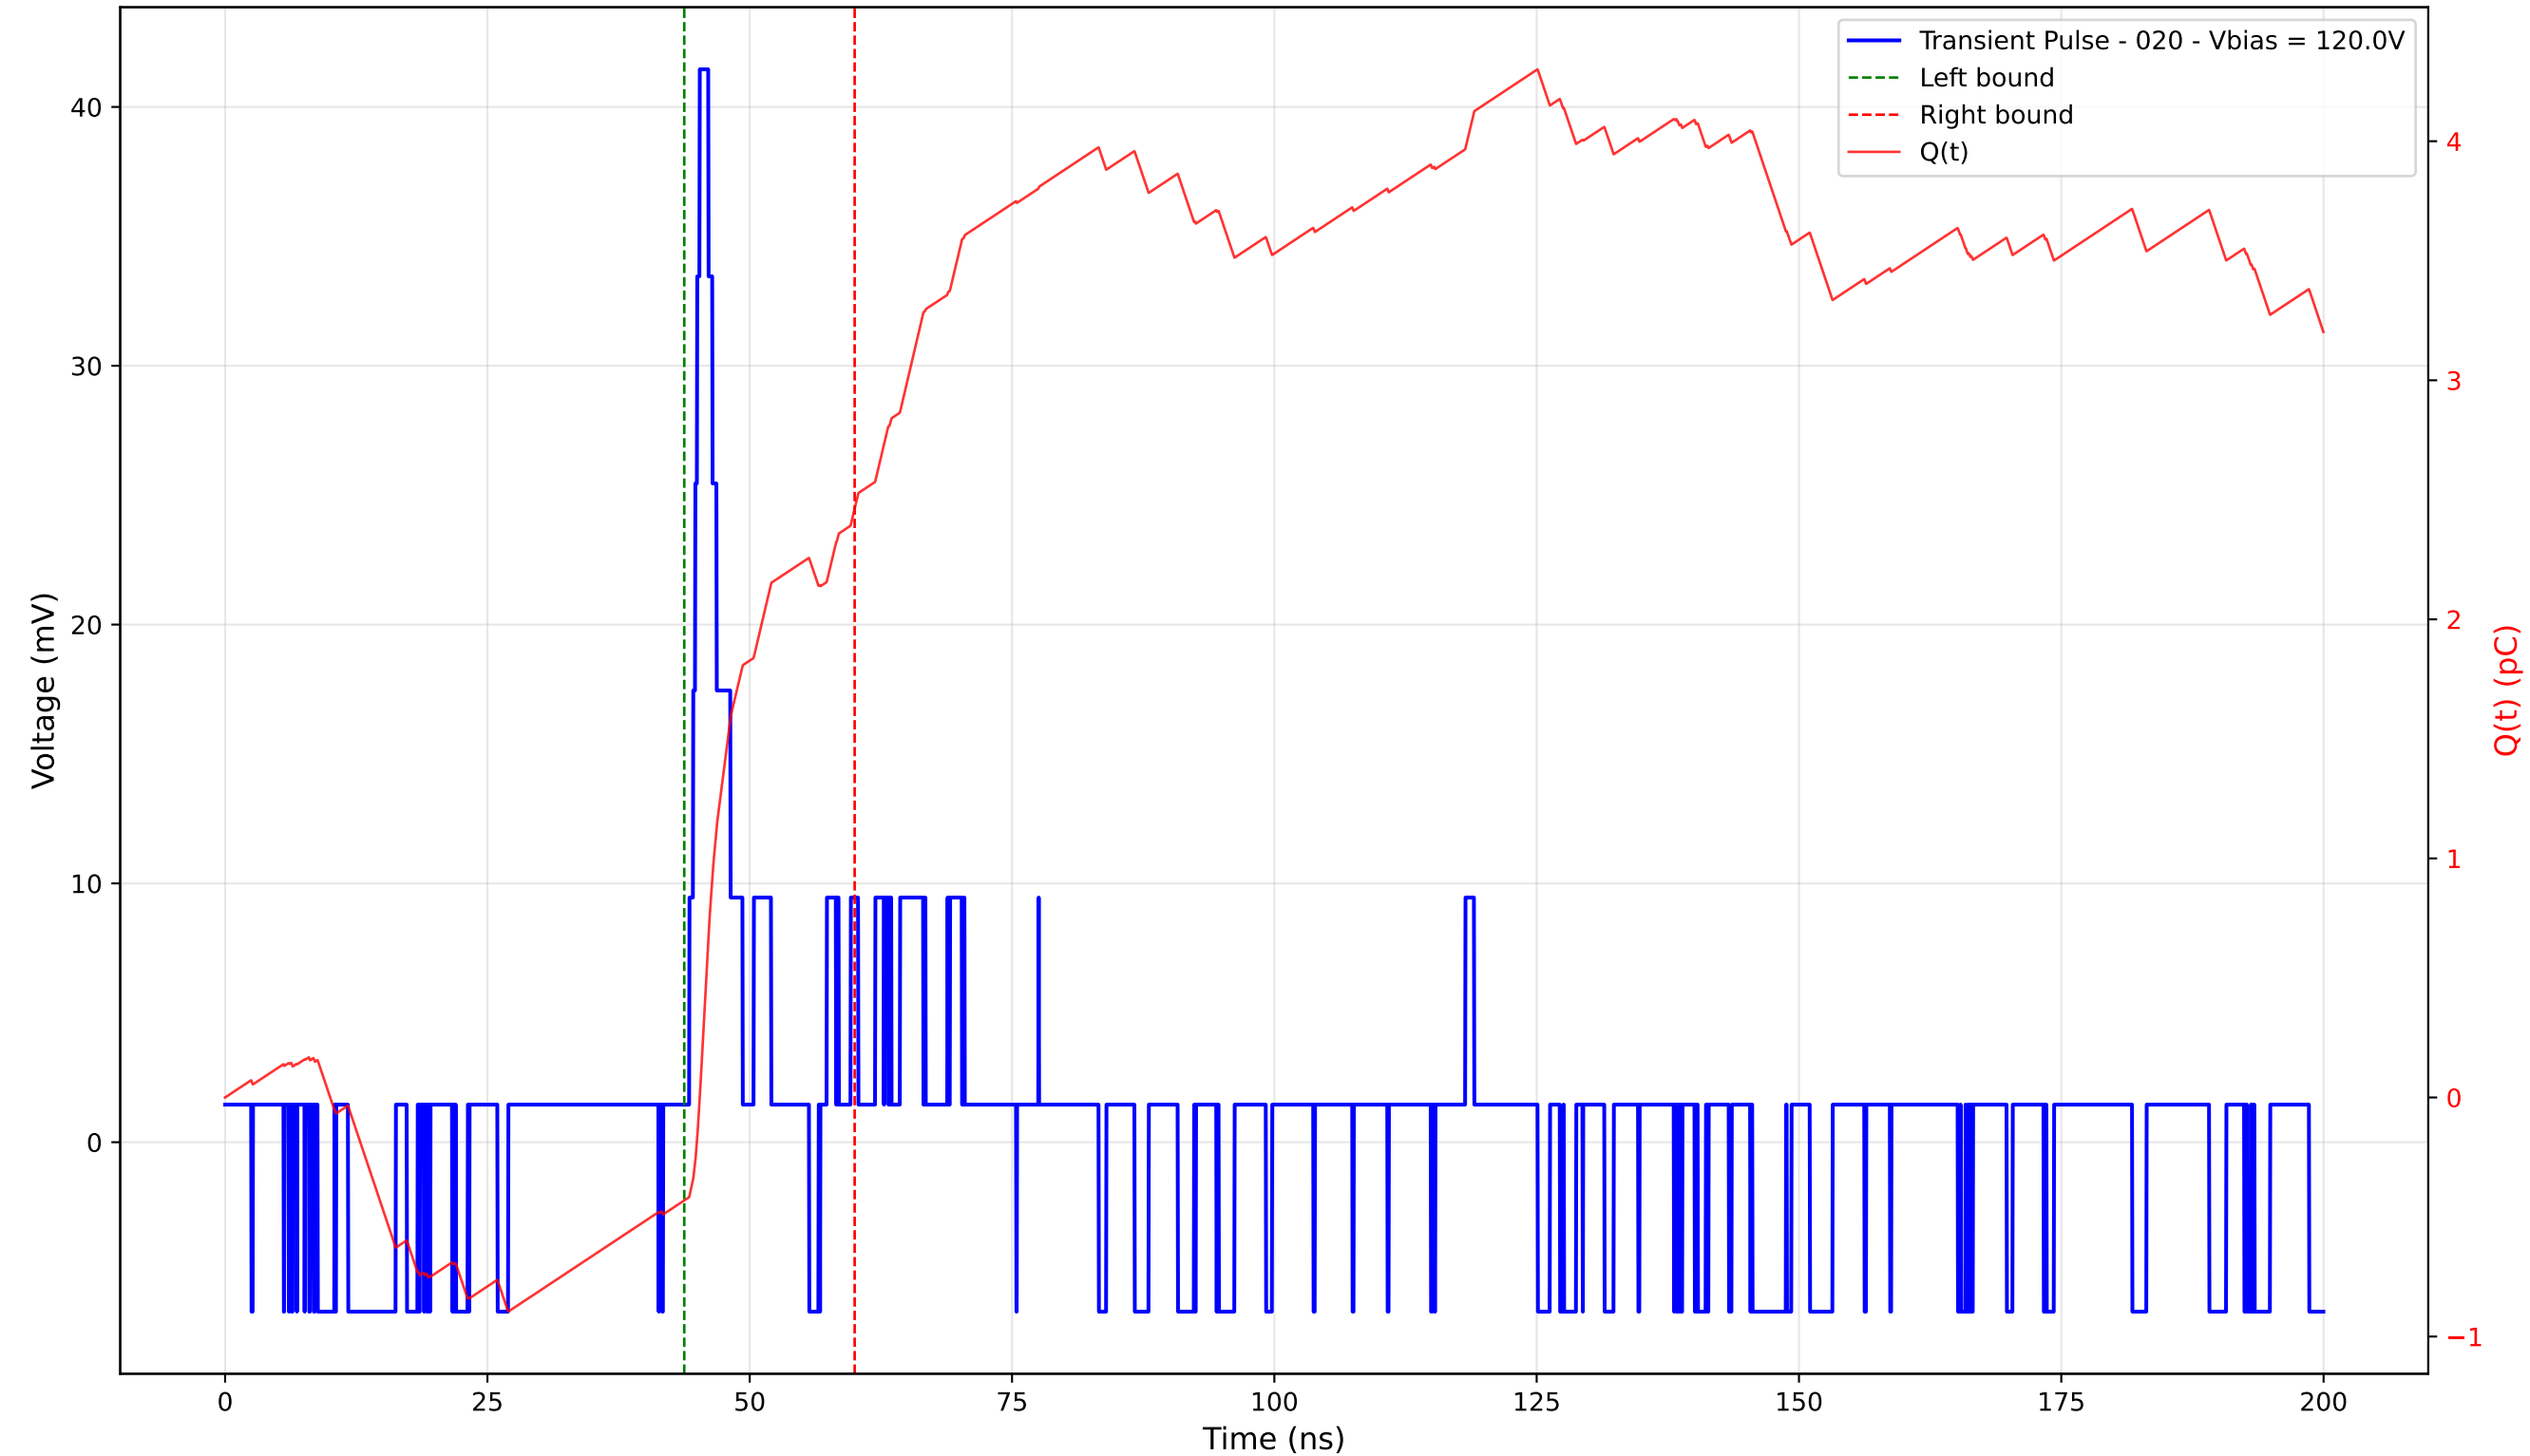


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 3.13 pC - Rise Time: 1.05 ns

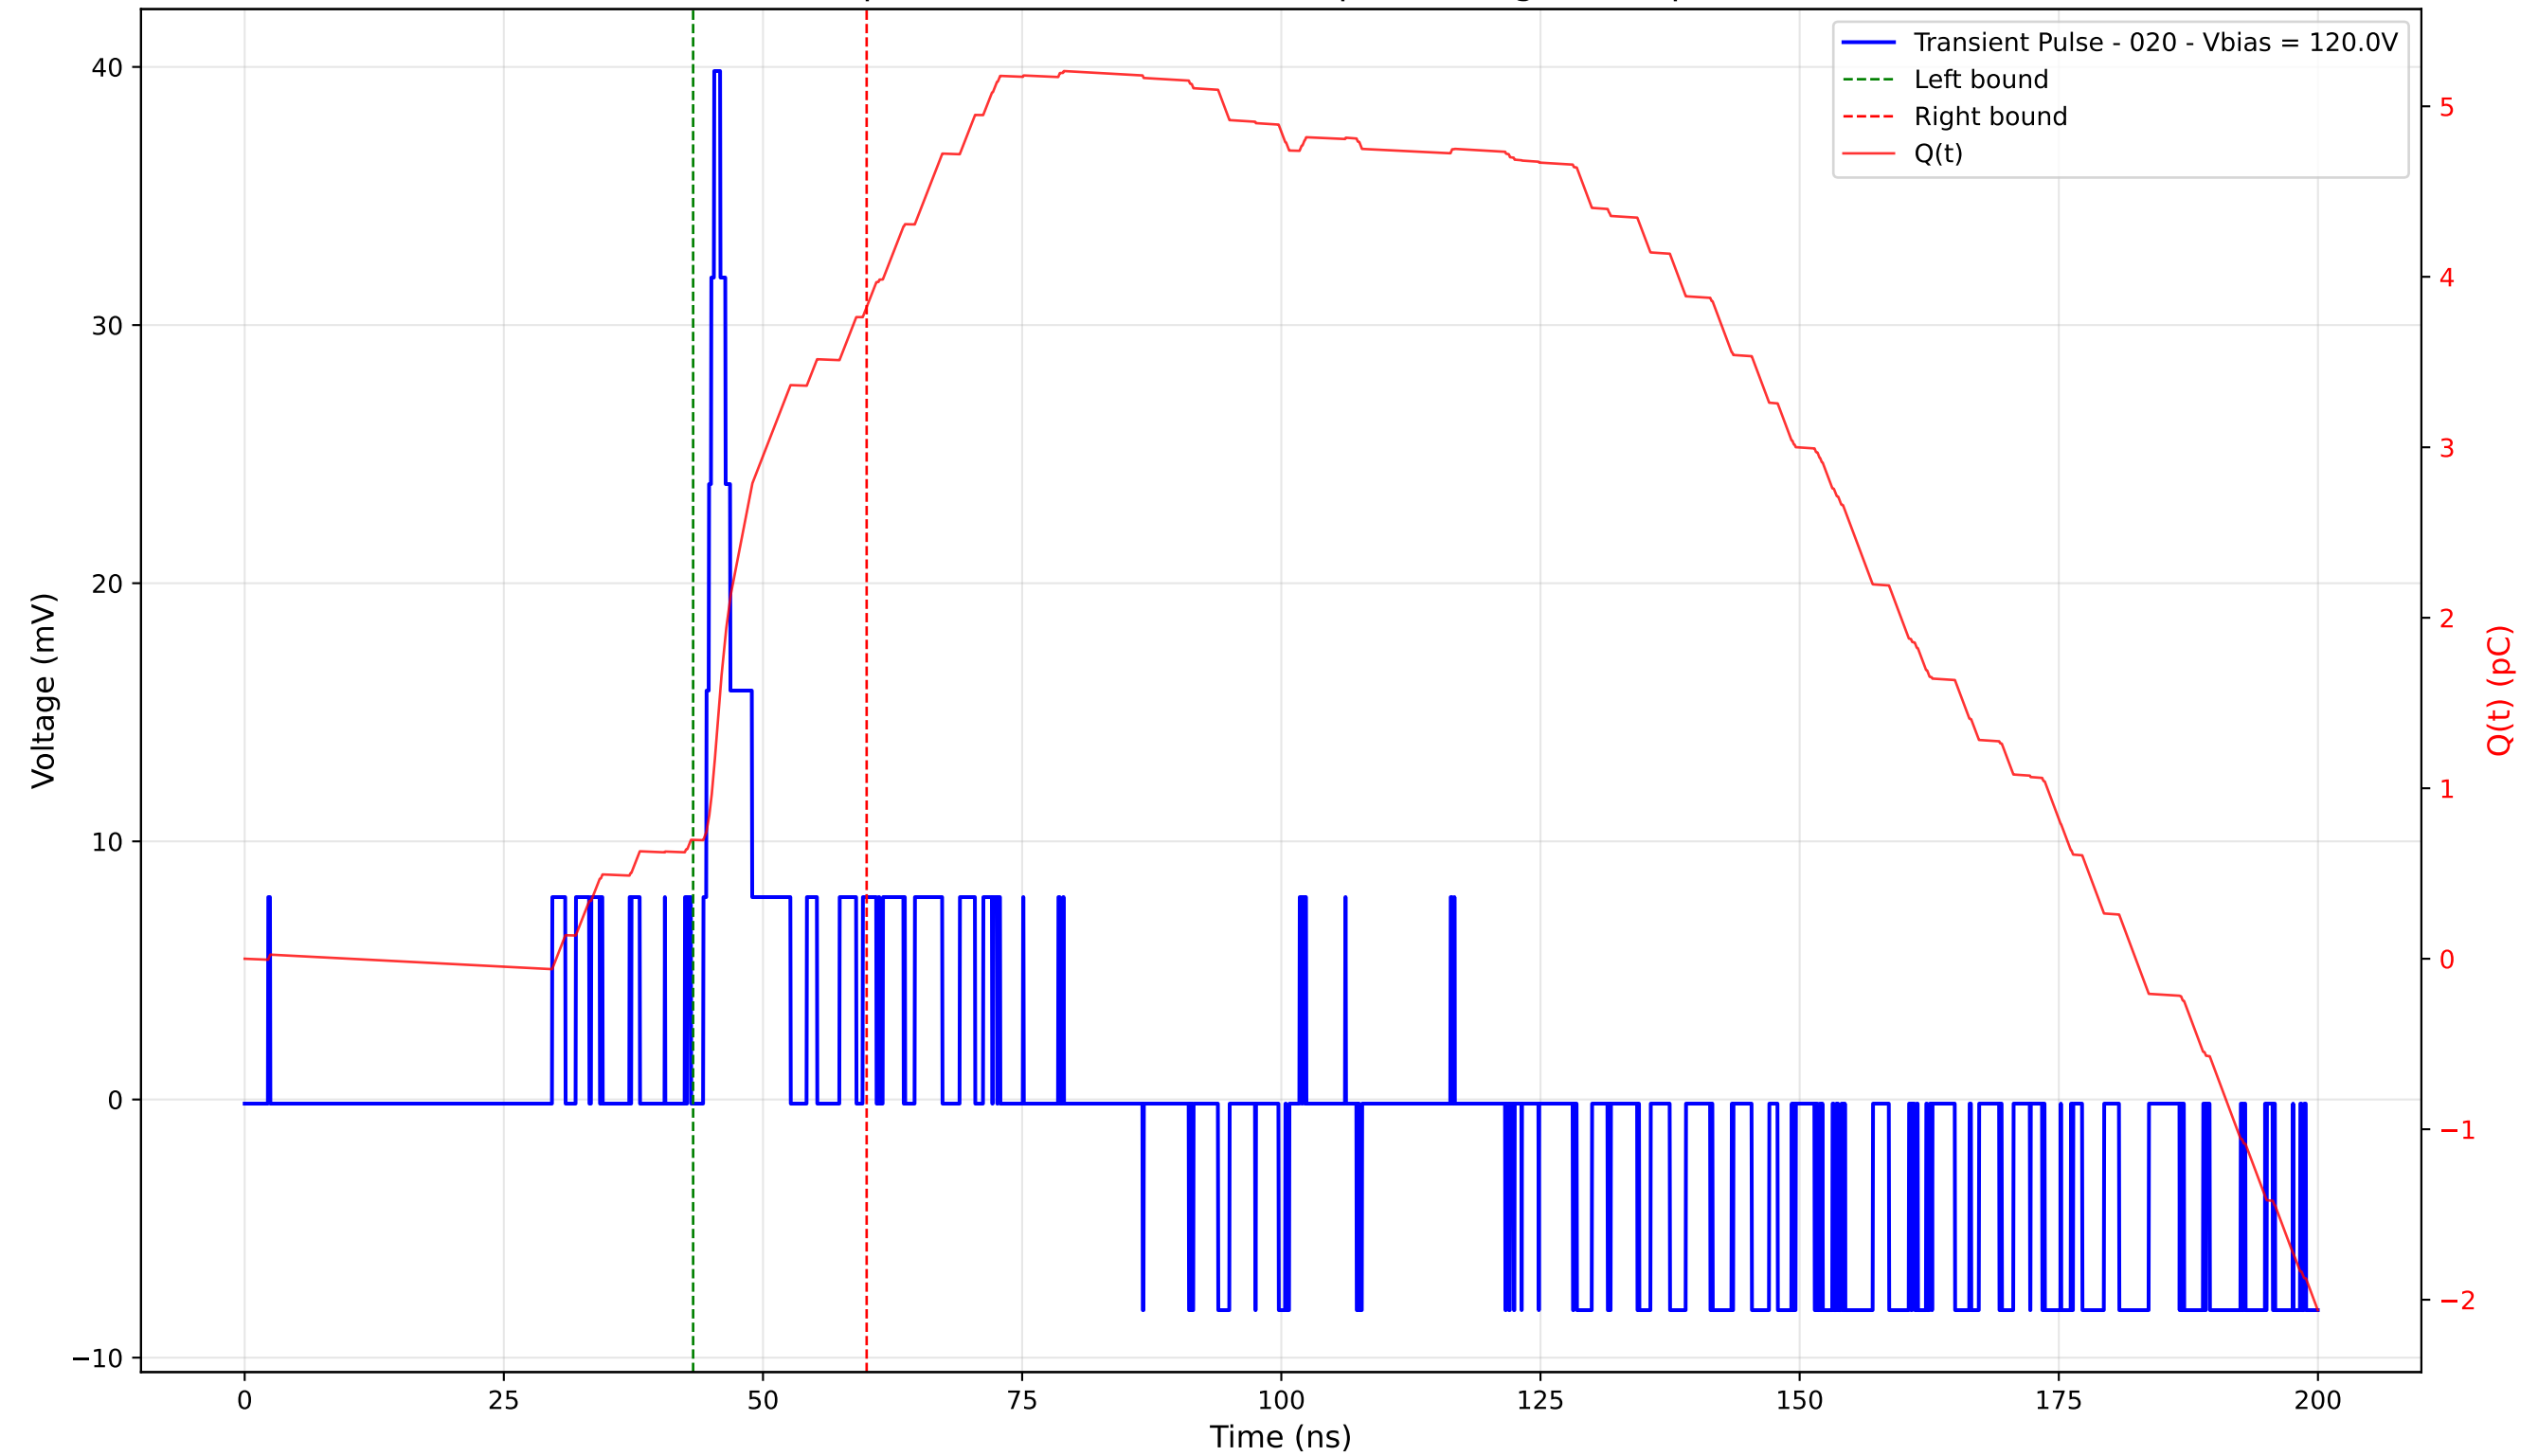


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 2.67 pC - Rise Time: 0.94 ns

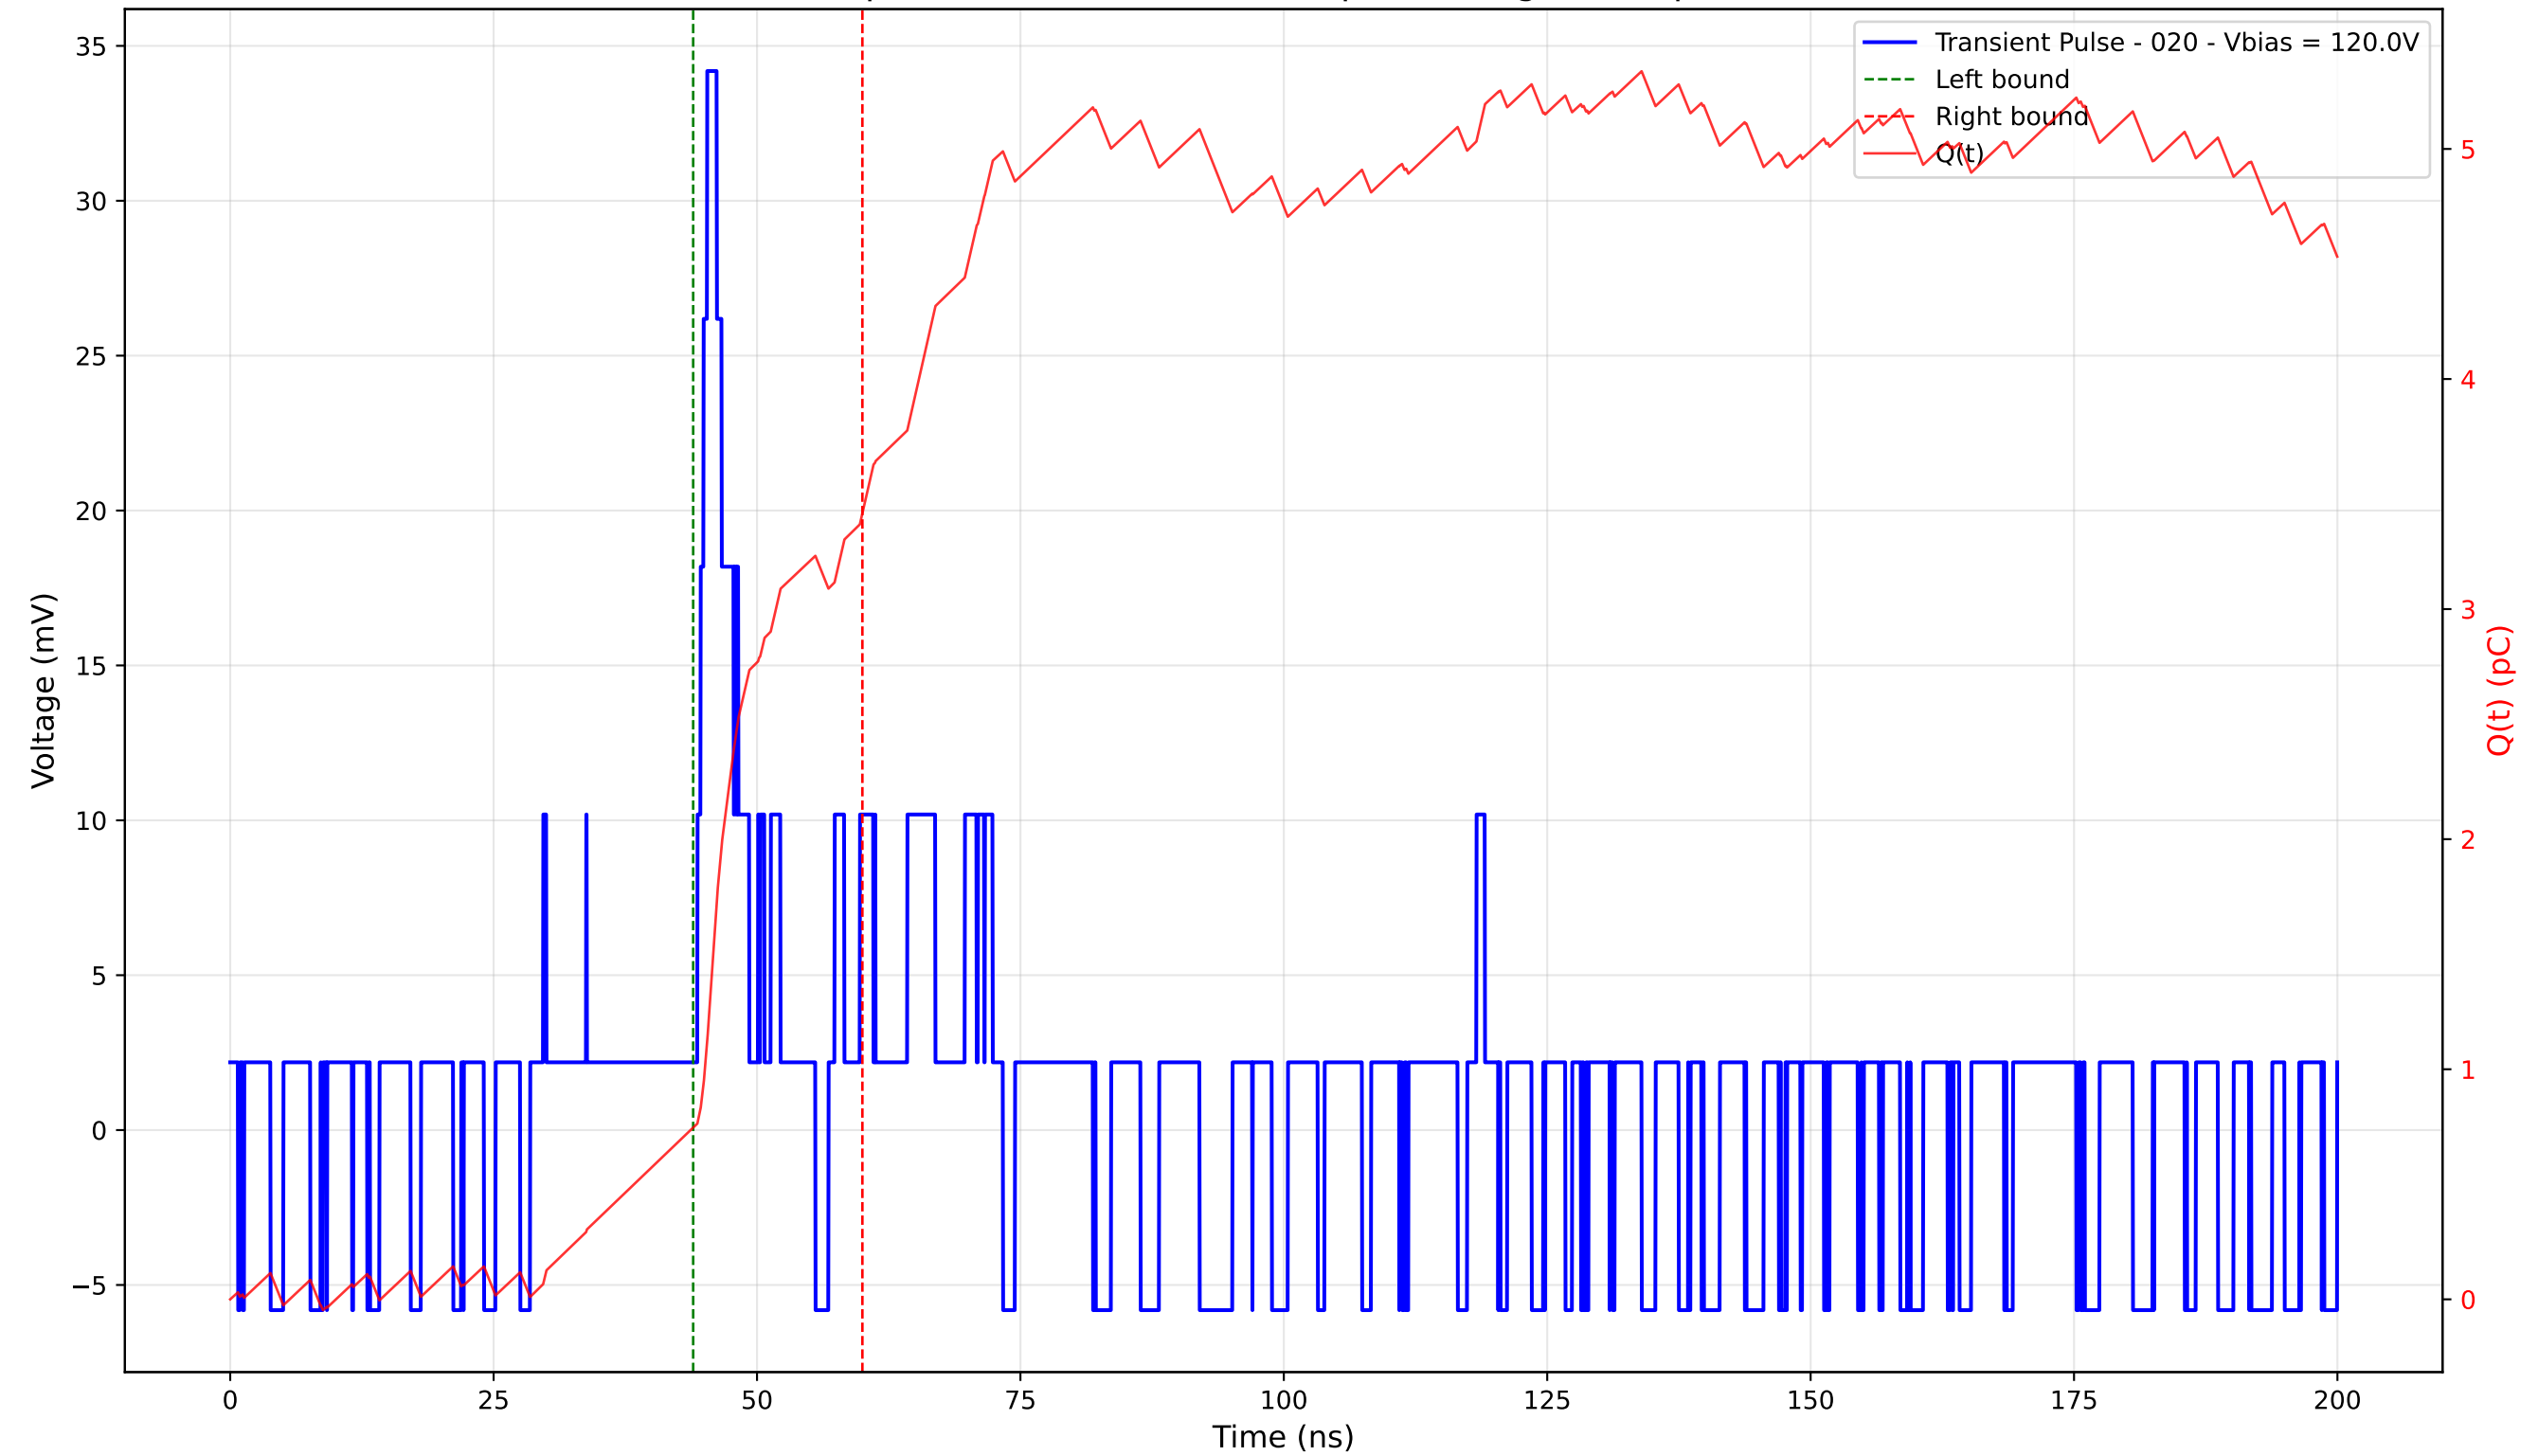

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.25 pC - Rise Time: 0.92 ns

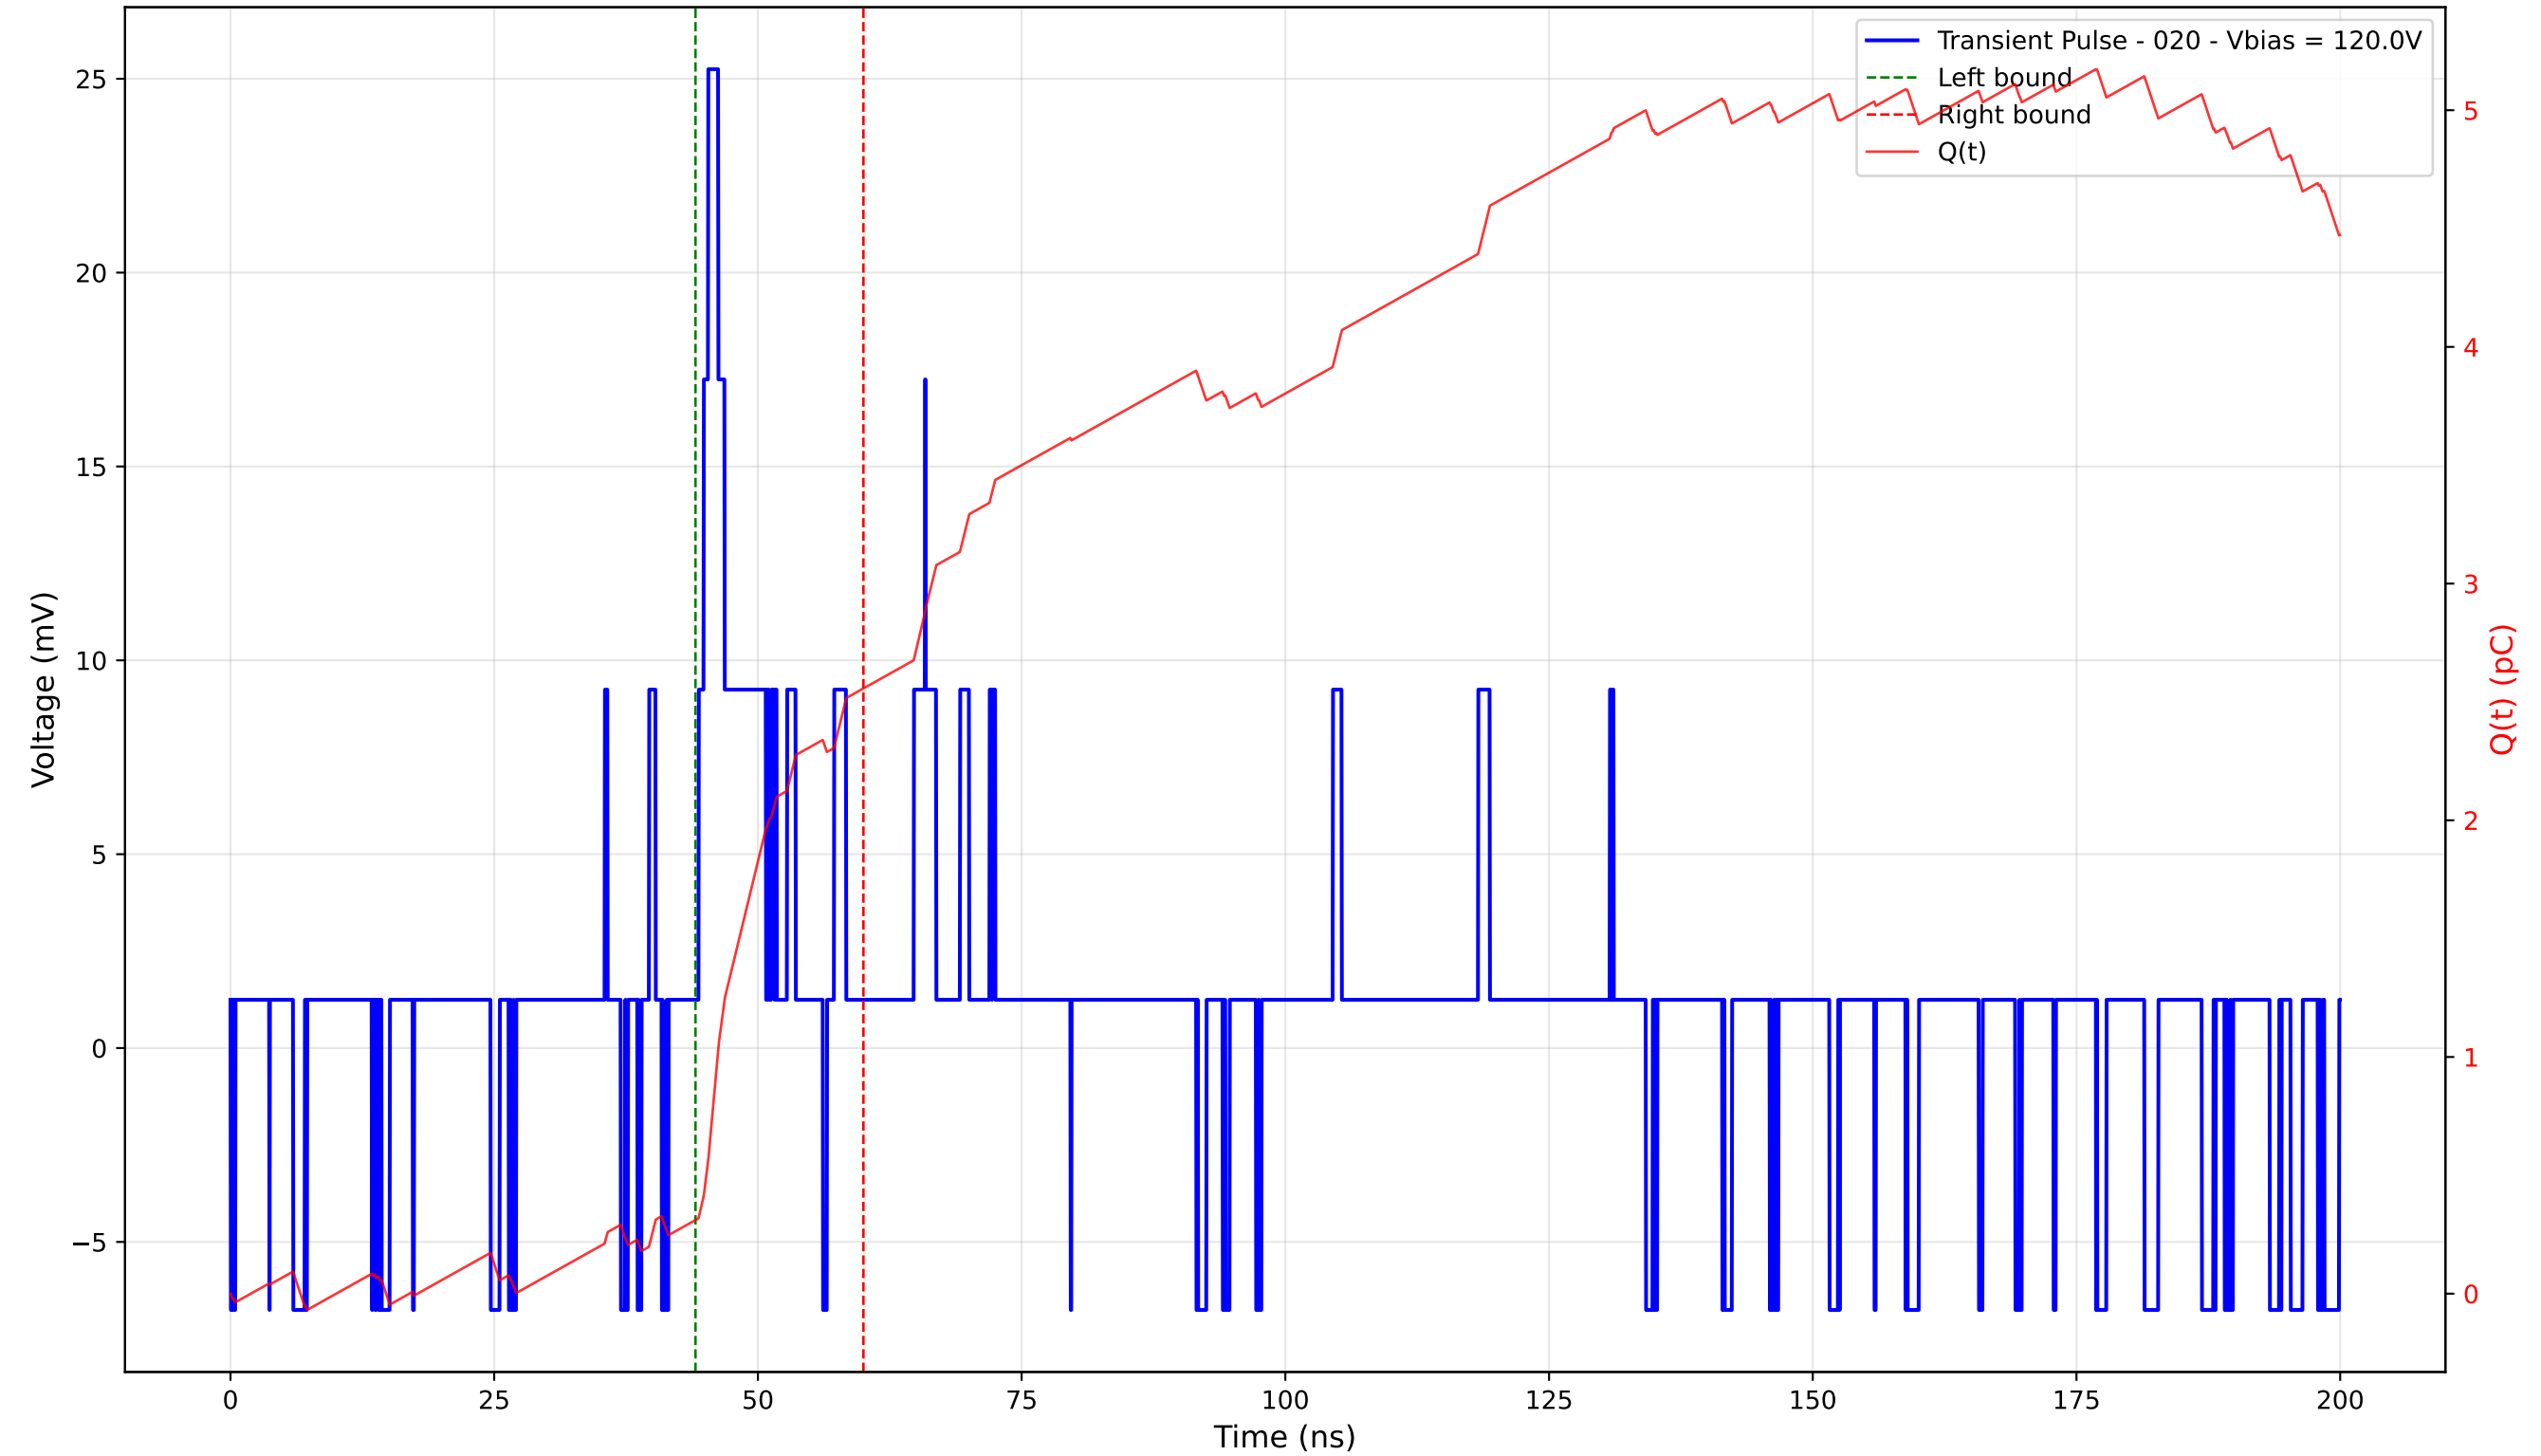

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 2.33 pC - Rise Time: 0.00 ns (N/A)

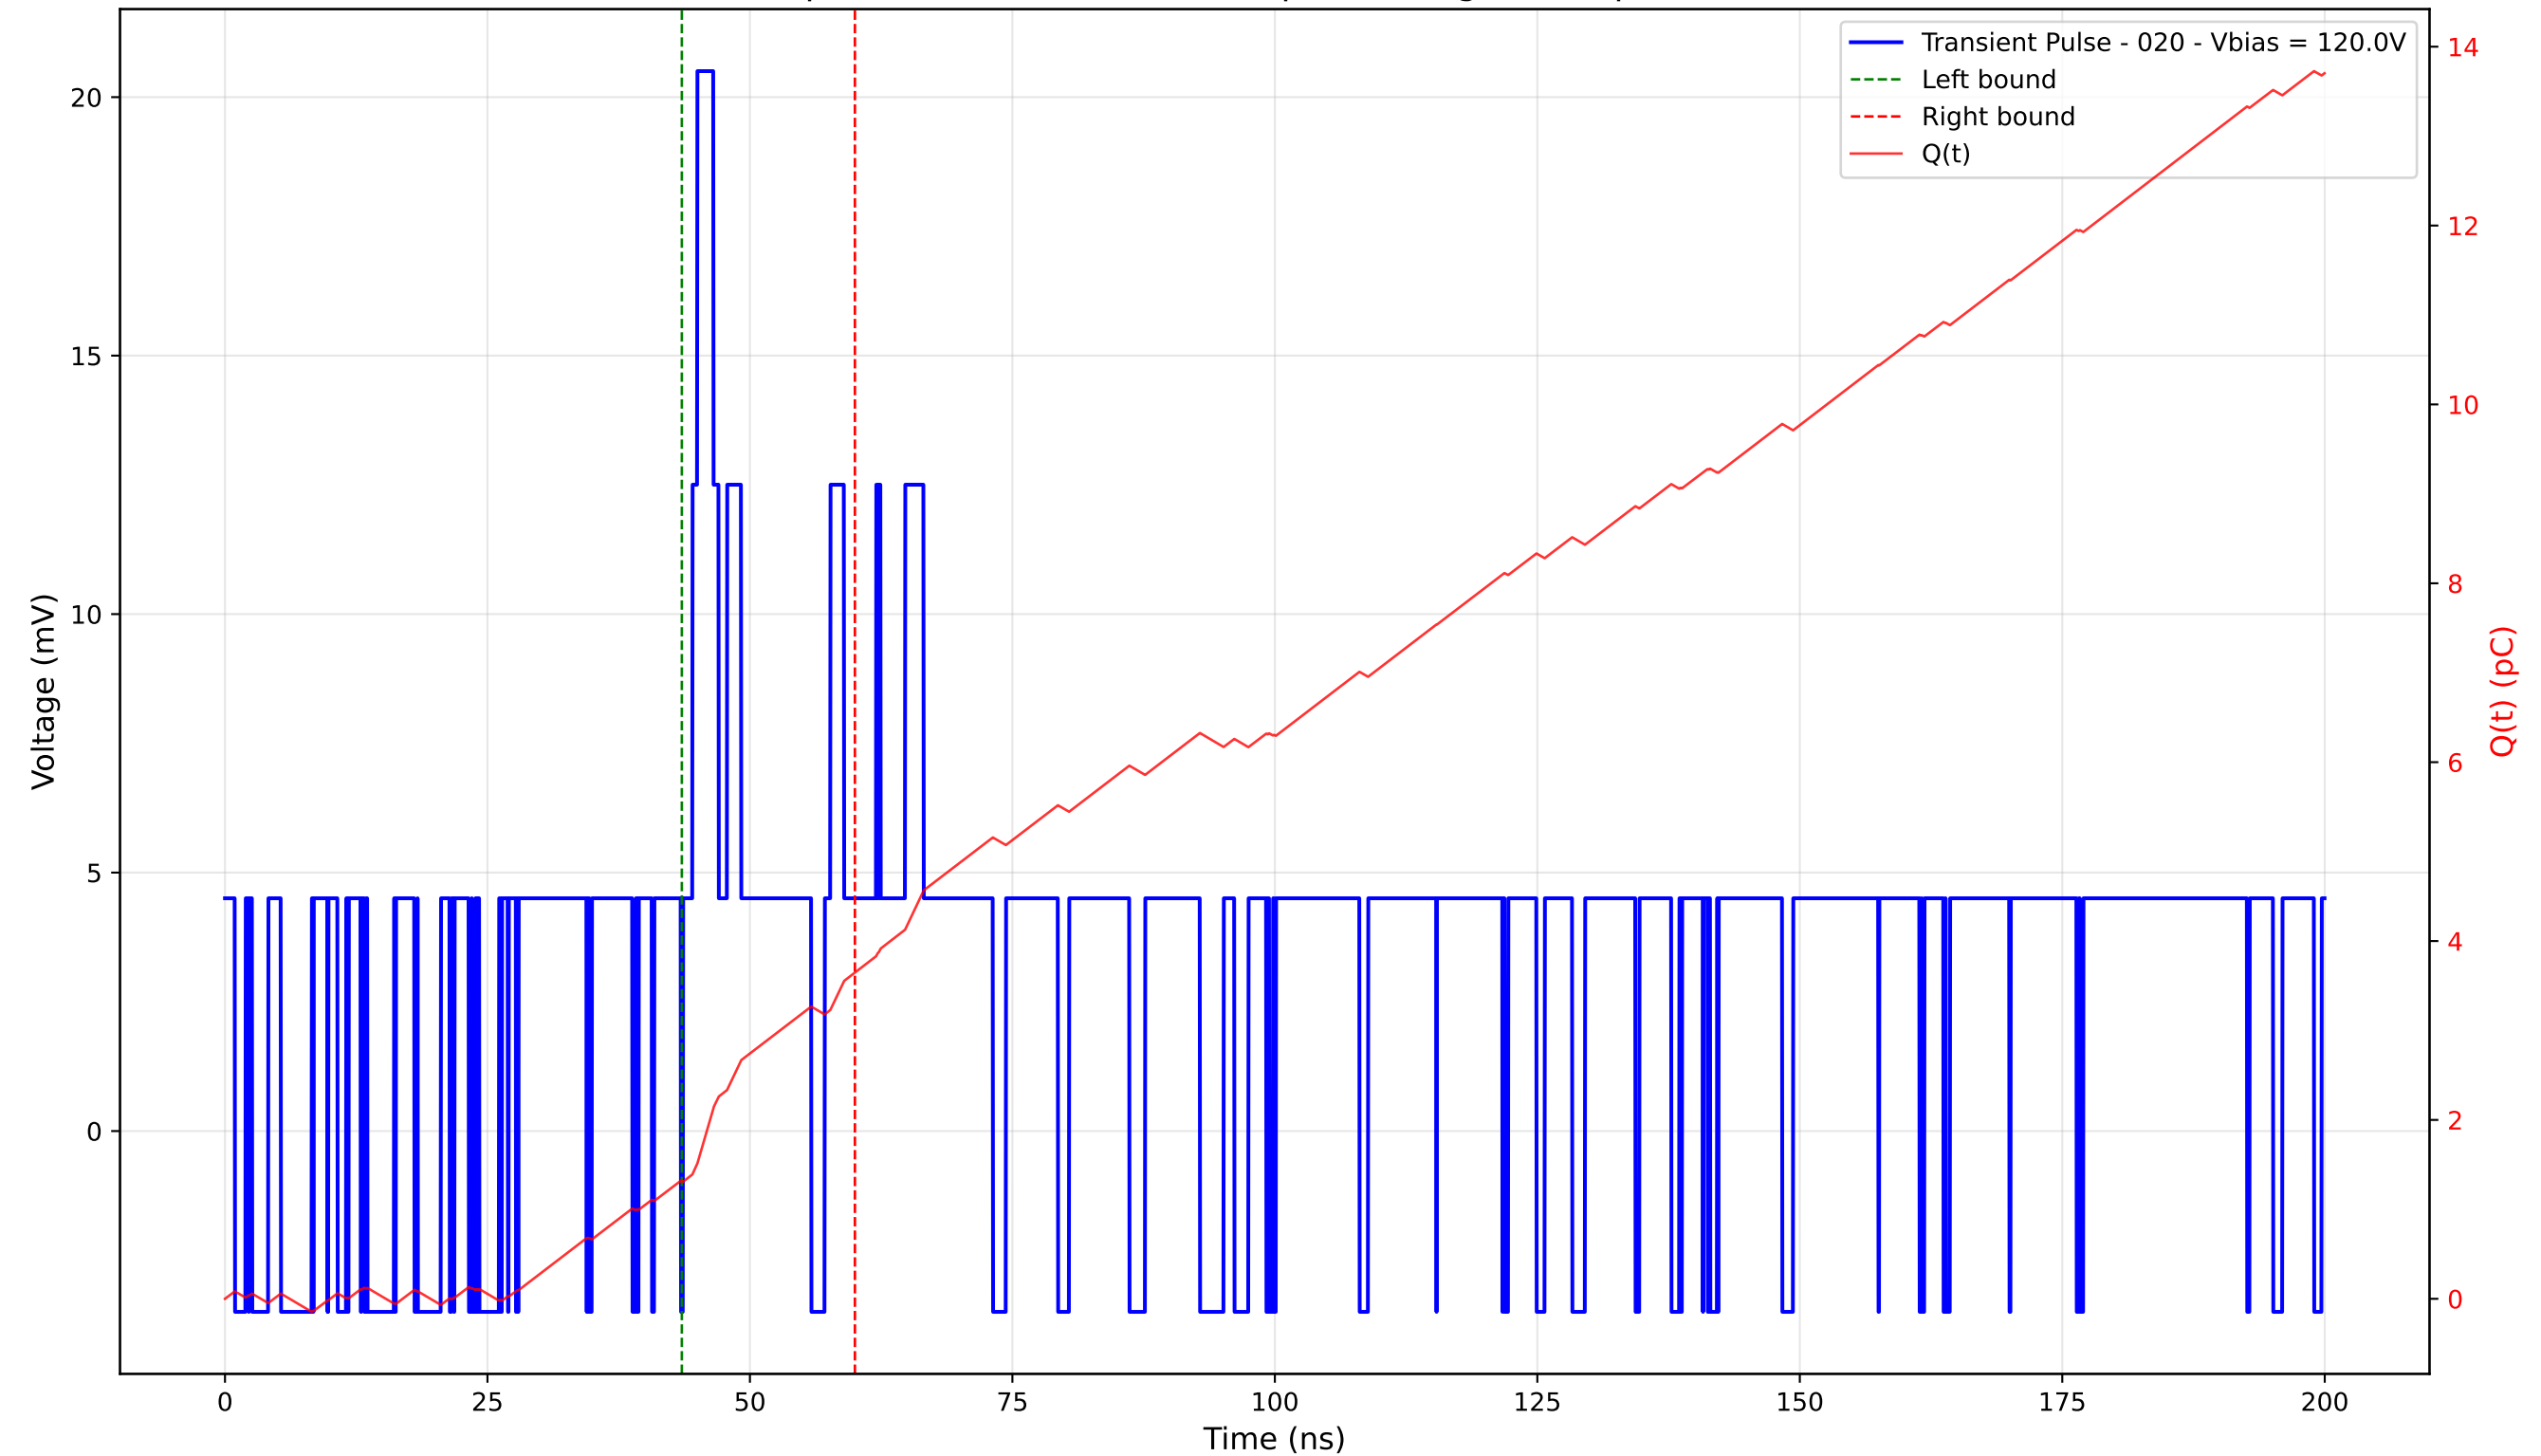

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 2.64 pC - Rise Time: 0.00 ns (N/A)

