


TCT Run 021 Summary

Parameter	Value
Run	Run021
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	110.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\110V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

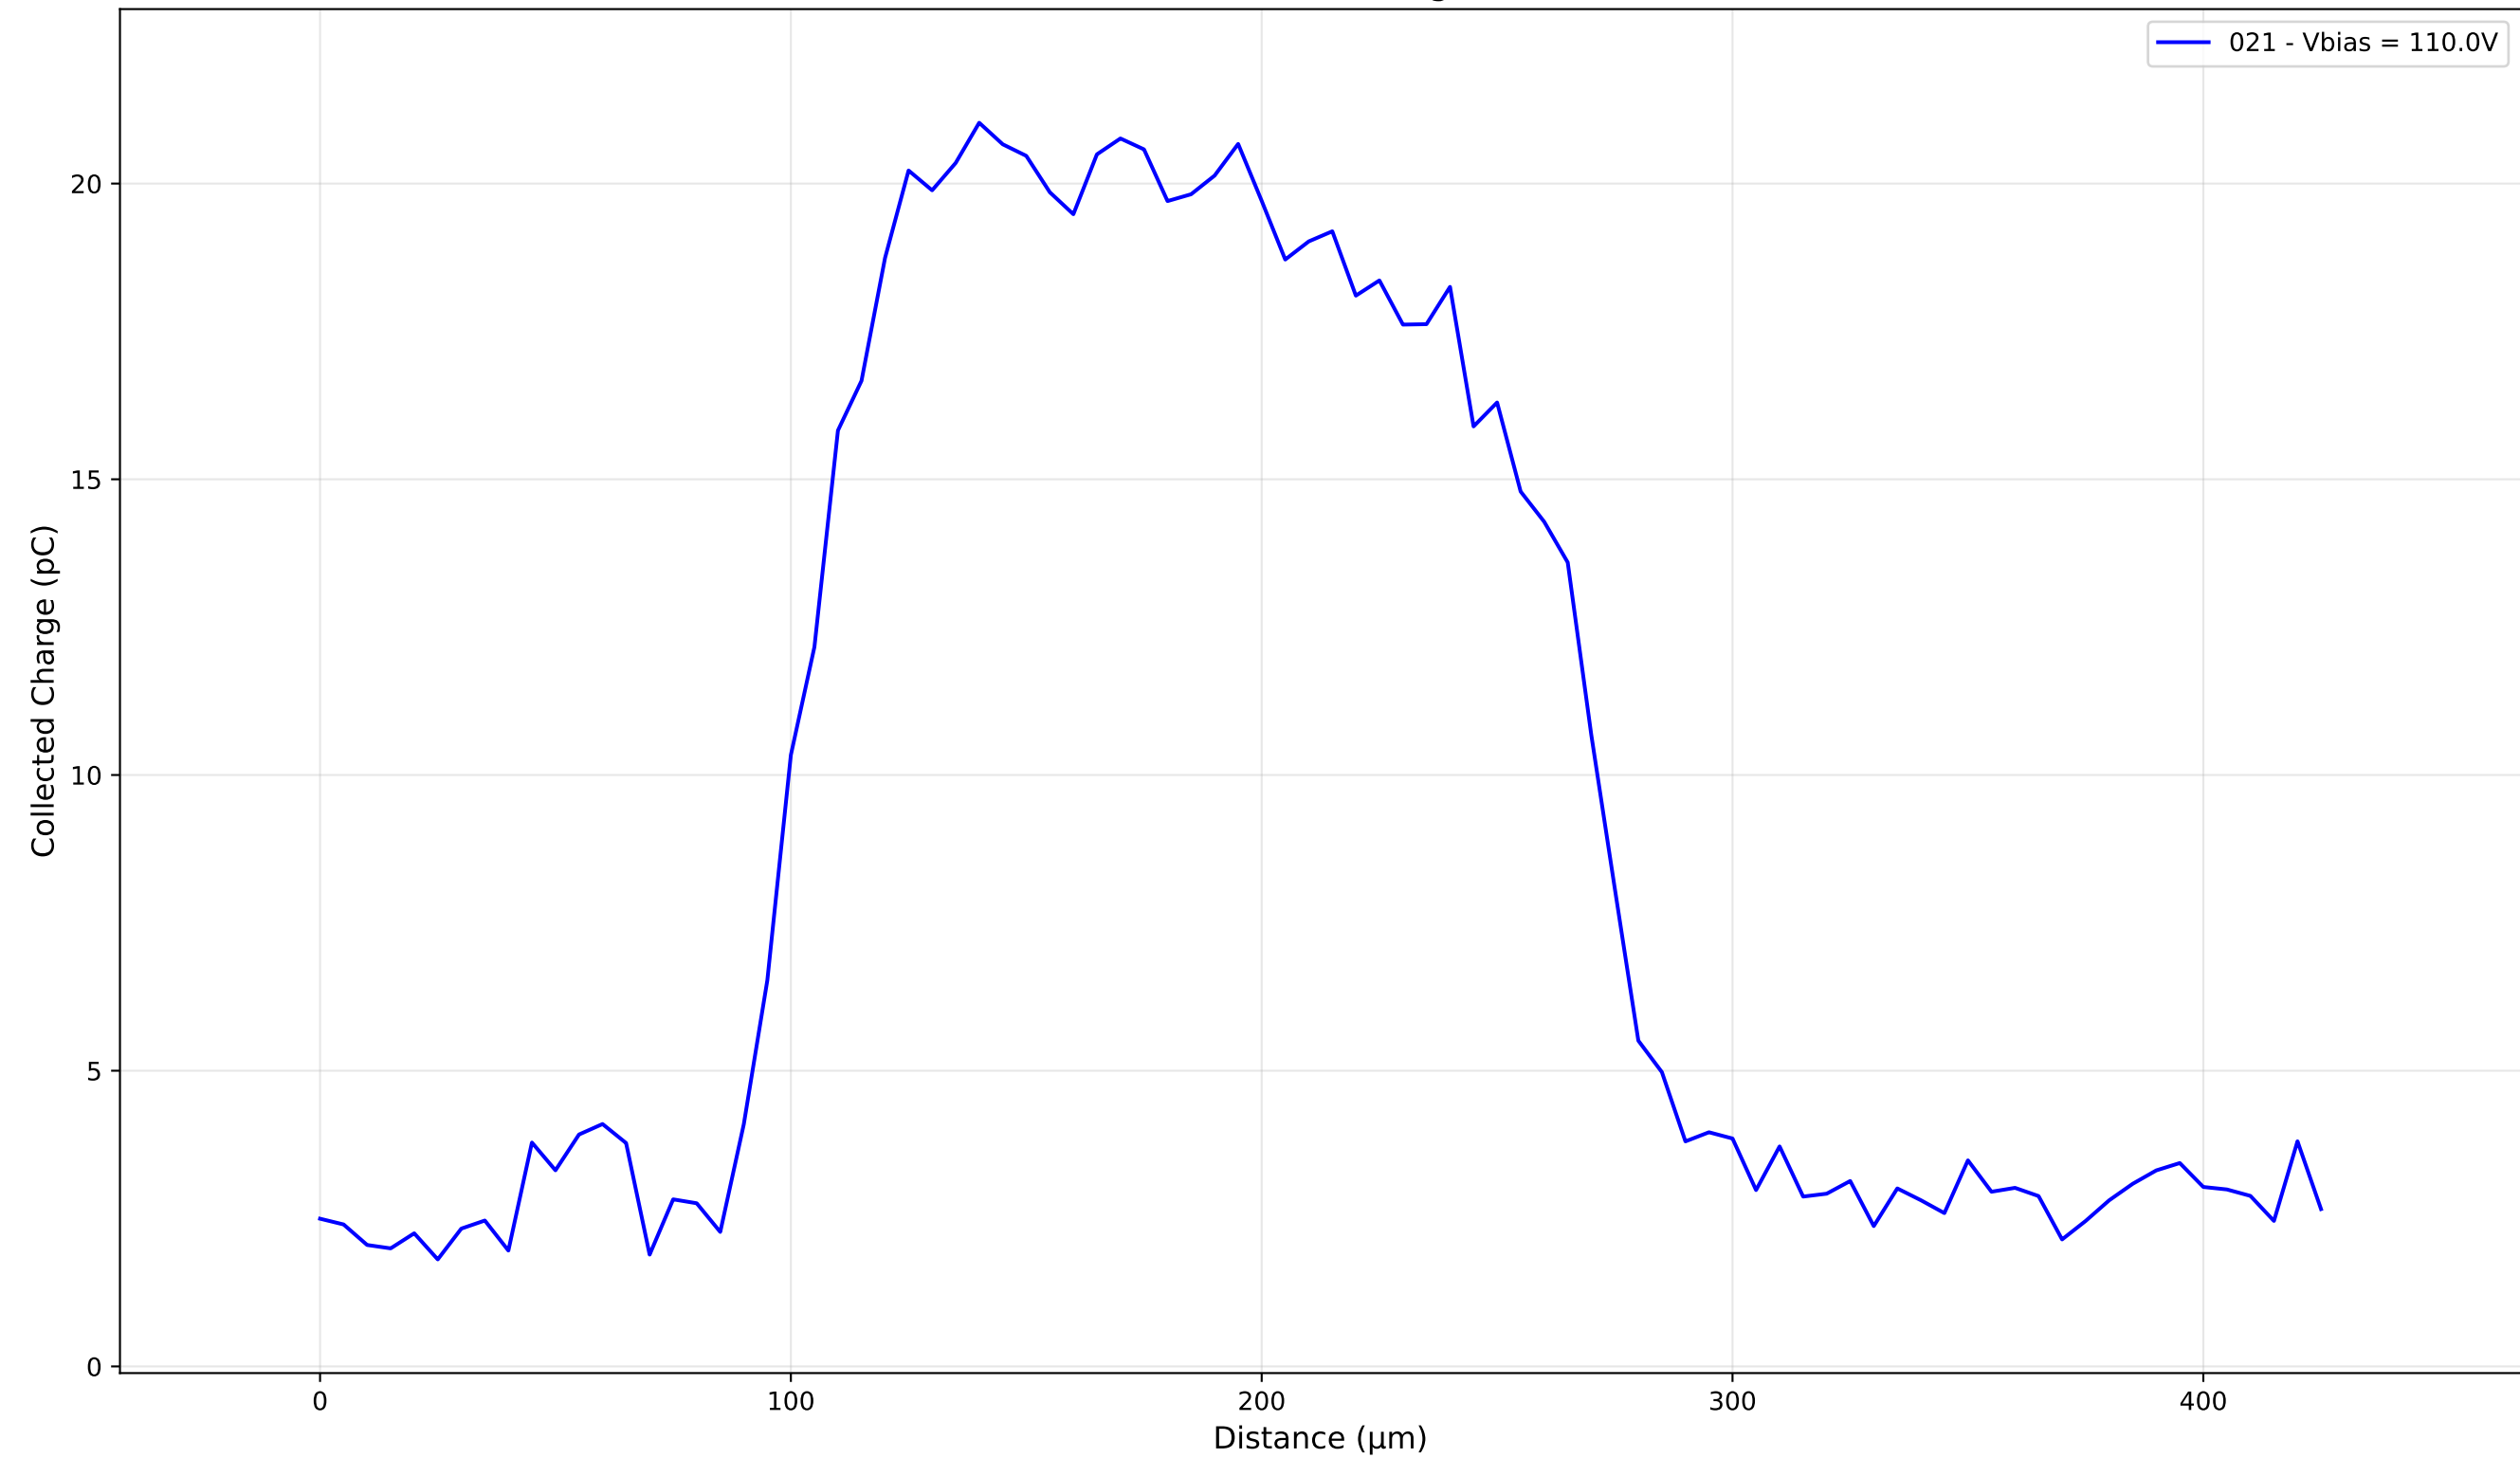

Collected Charge

021 - Vbias = 110.0V

Collected Charge [a.u.]

1.0

0.8

0.6

0.4

0.2

0.0

0


100

200


300

400


Distance (μm)

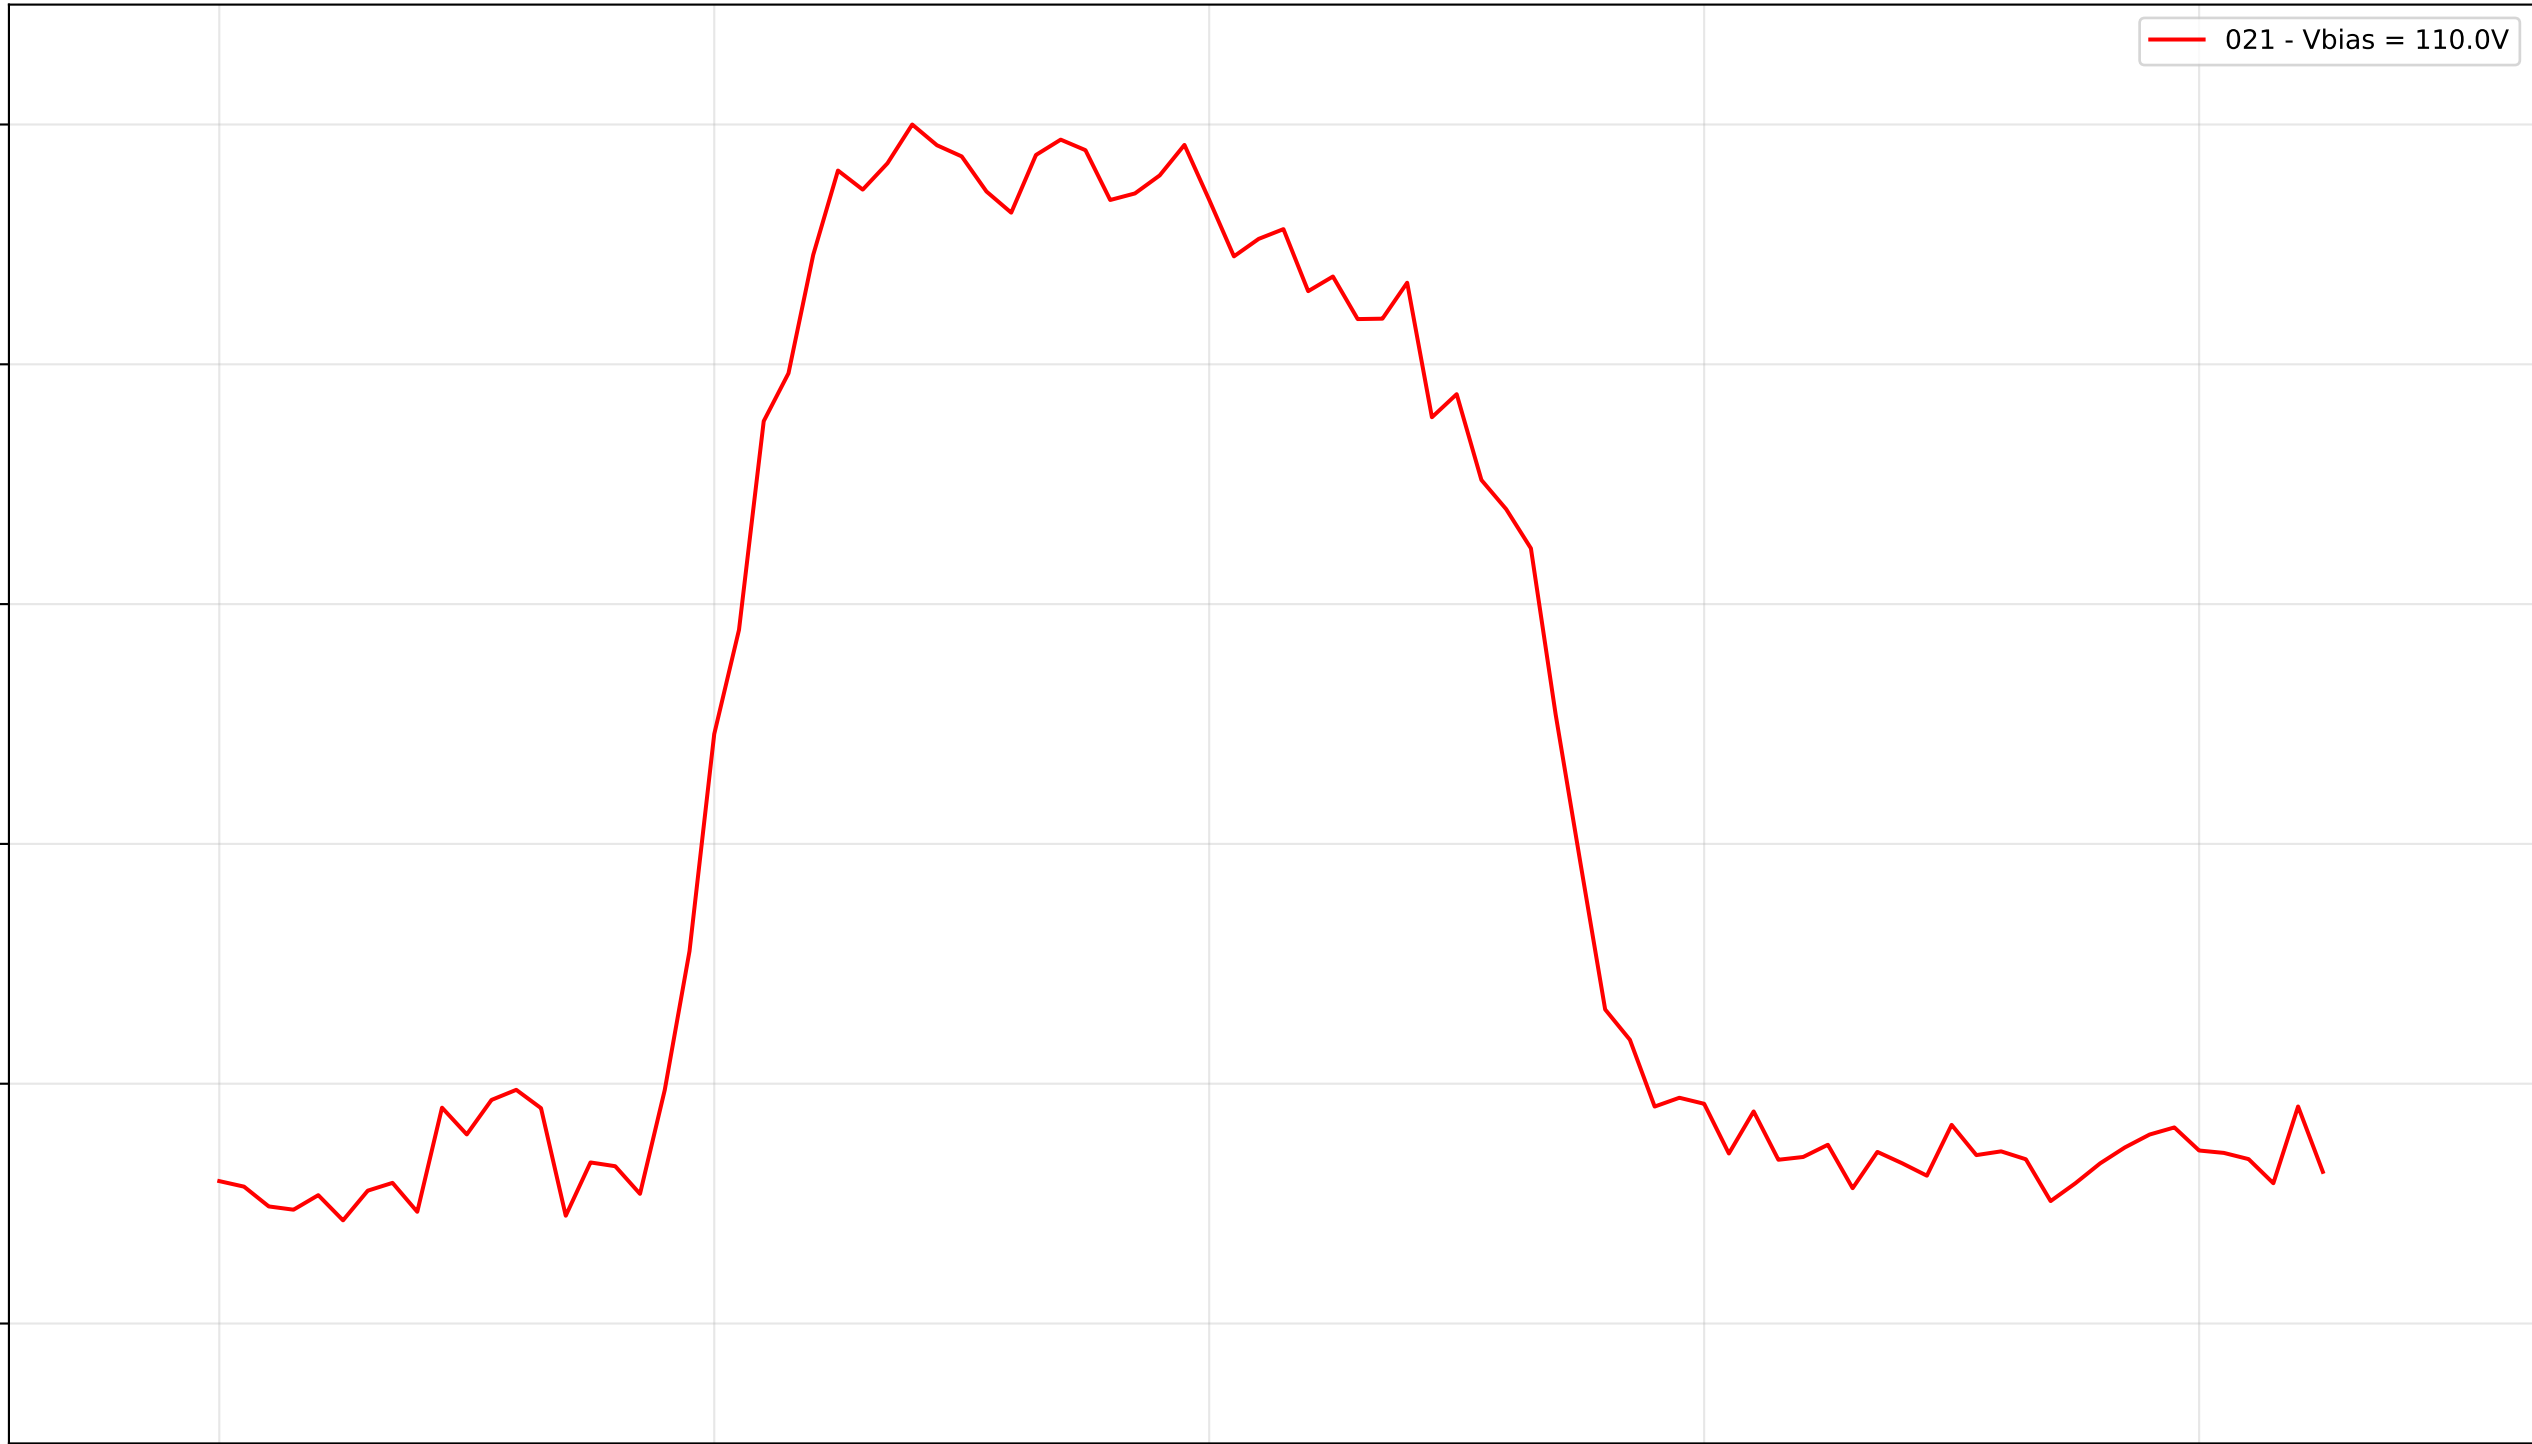


Rise Time

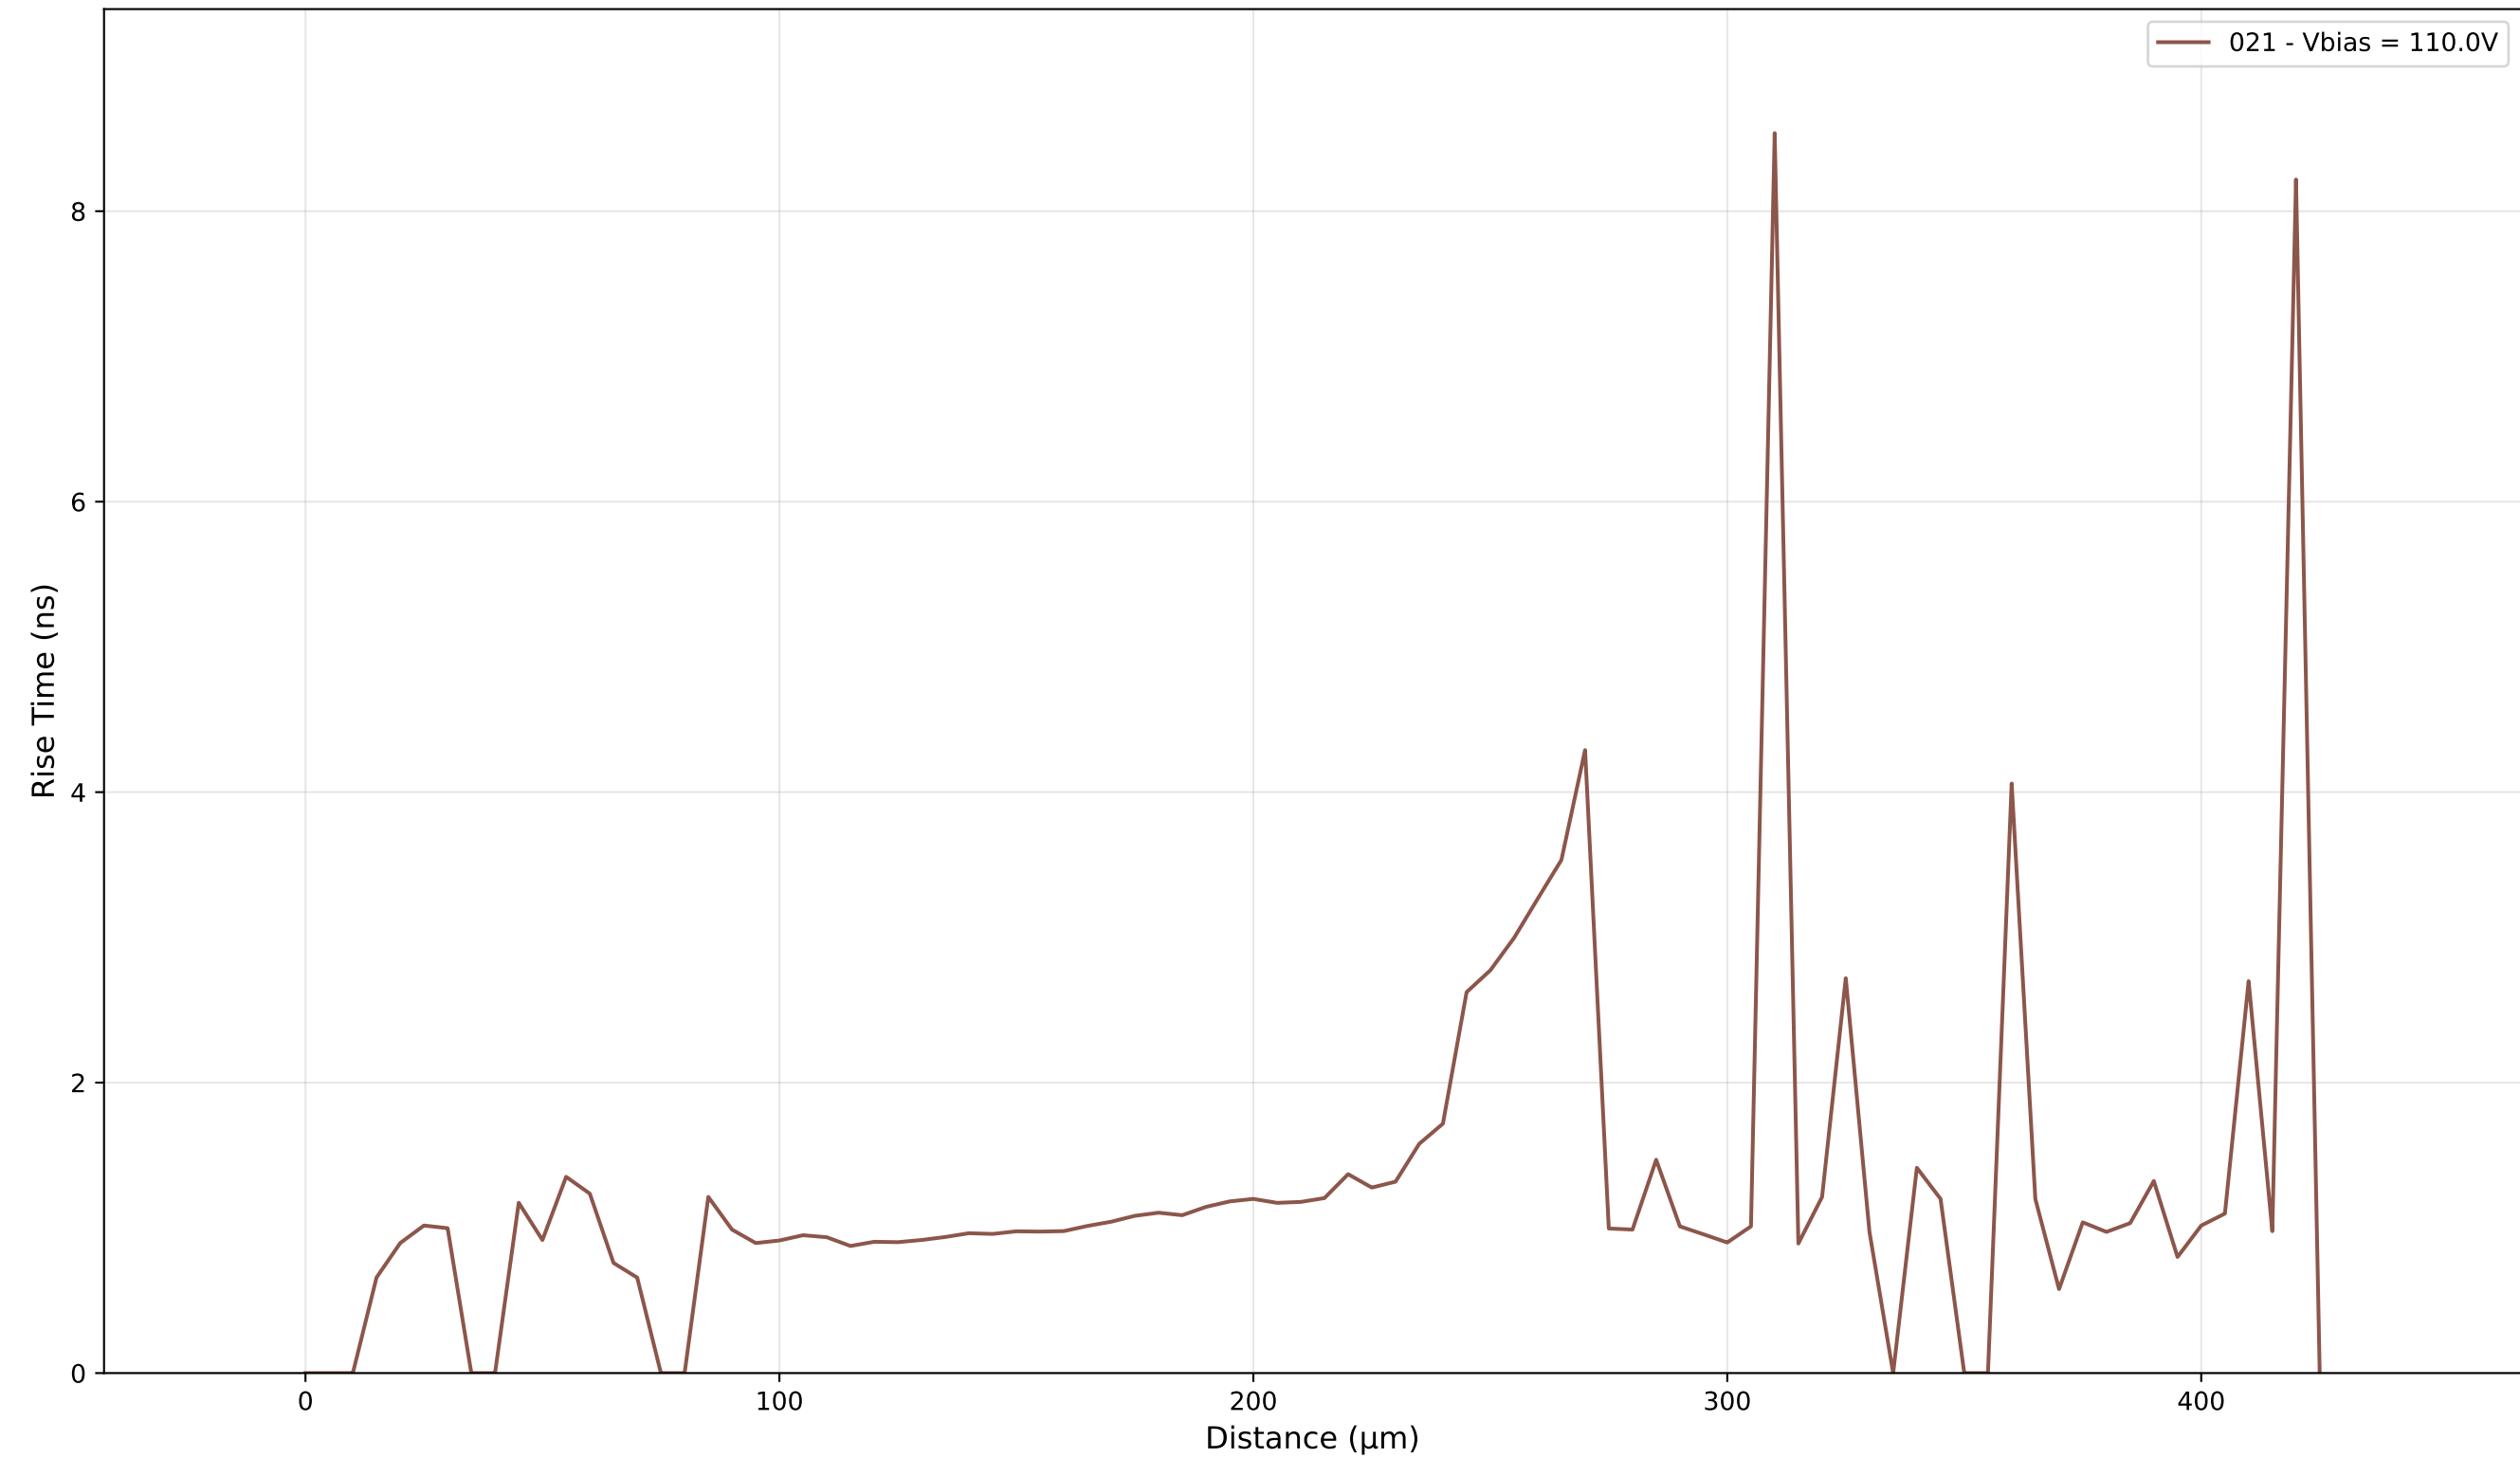


Amplitude

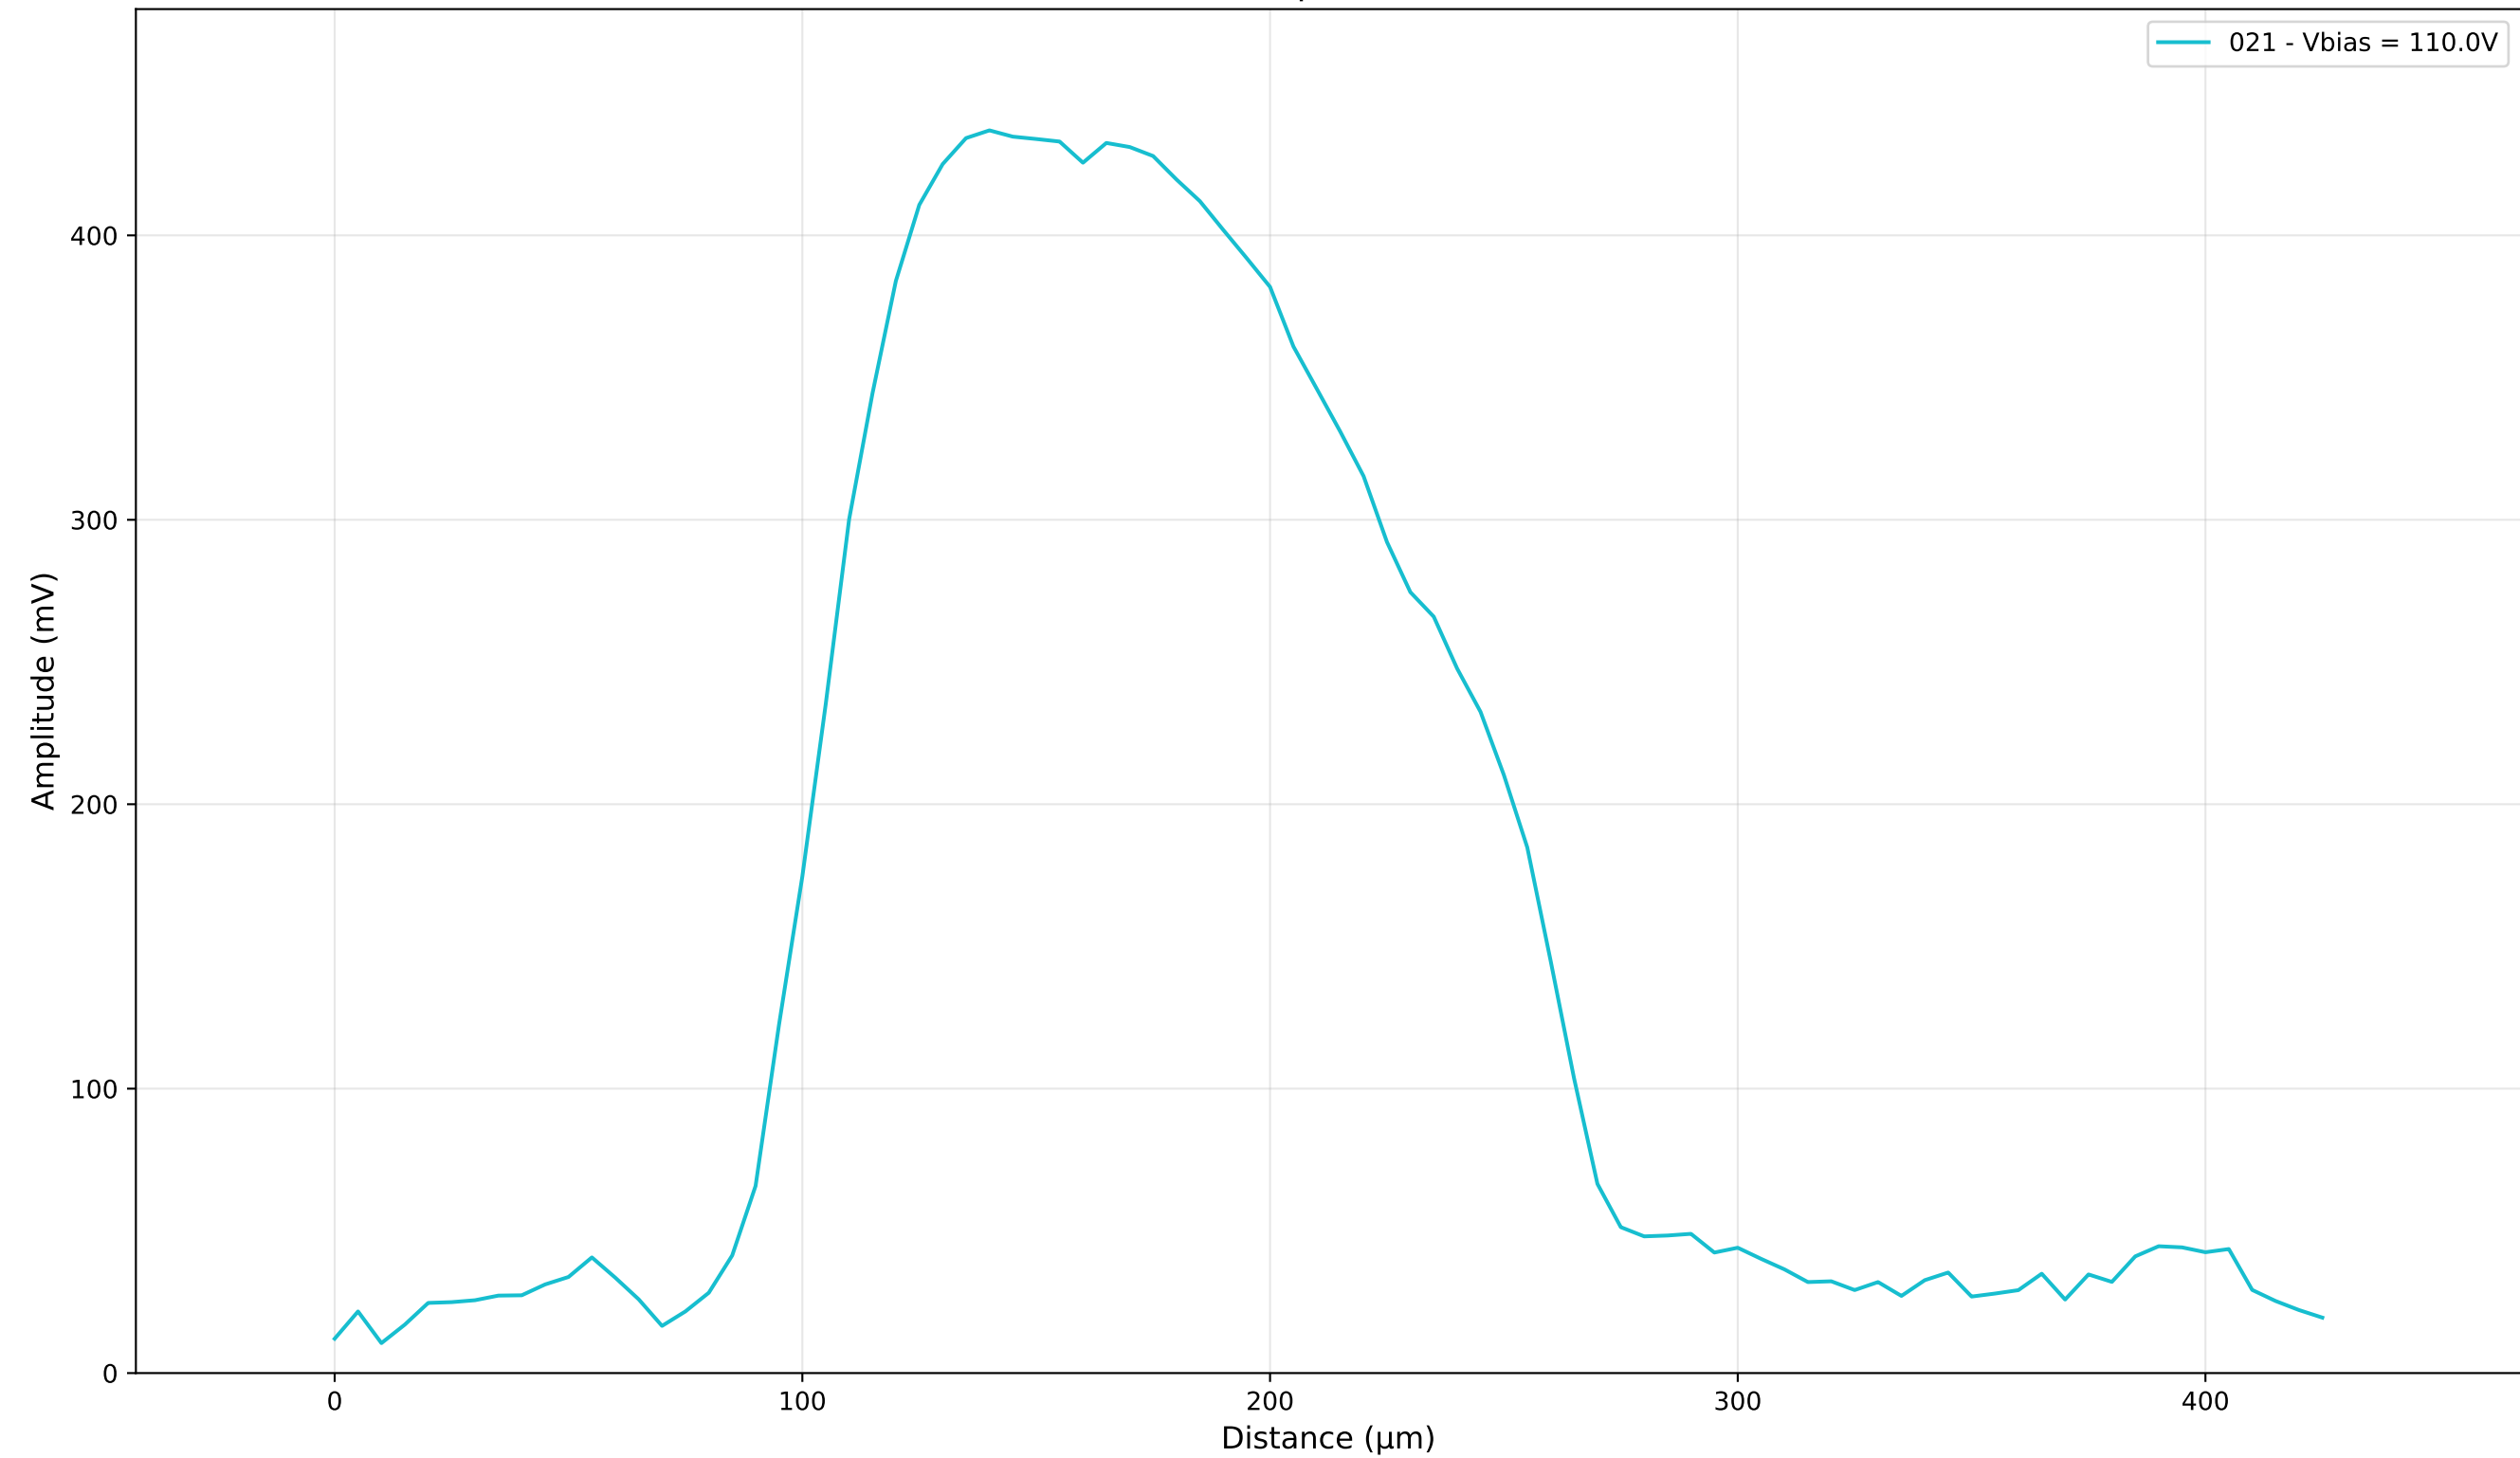


FWHM

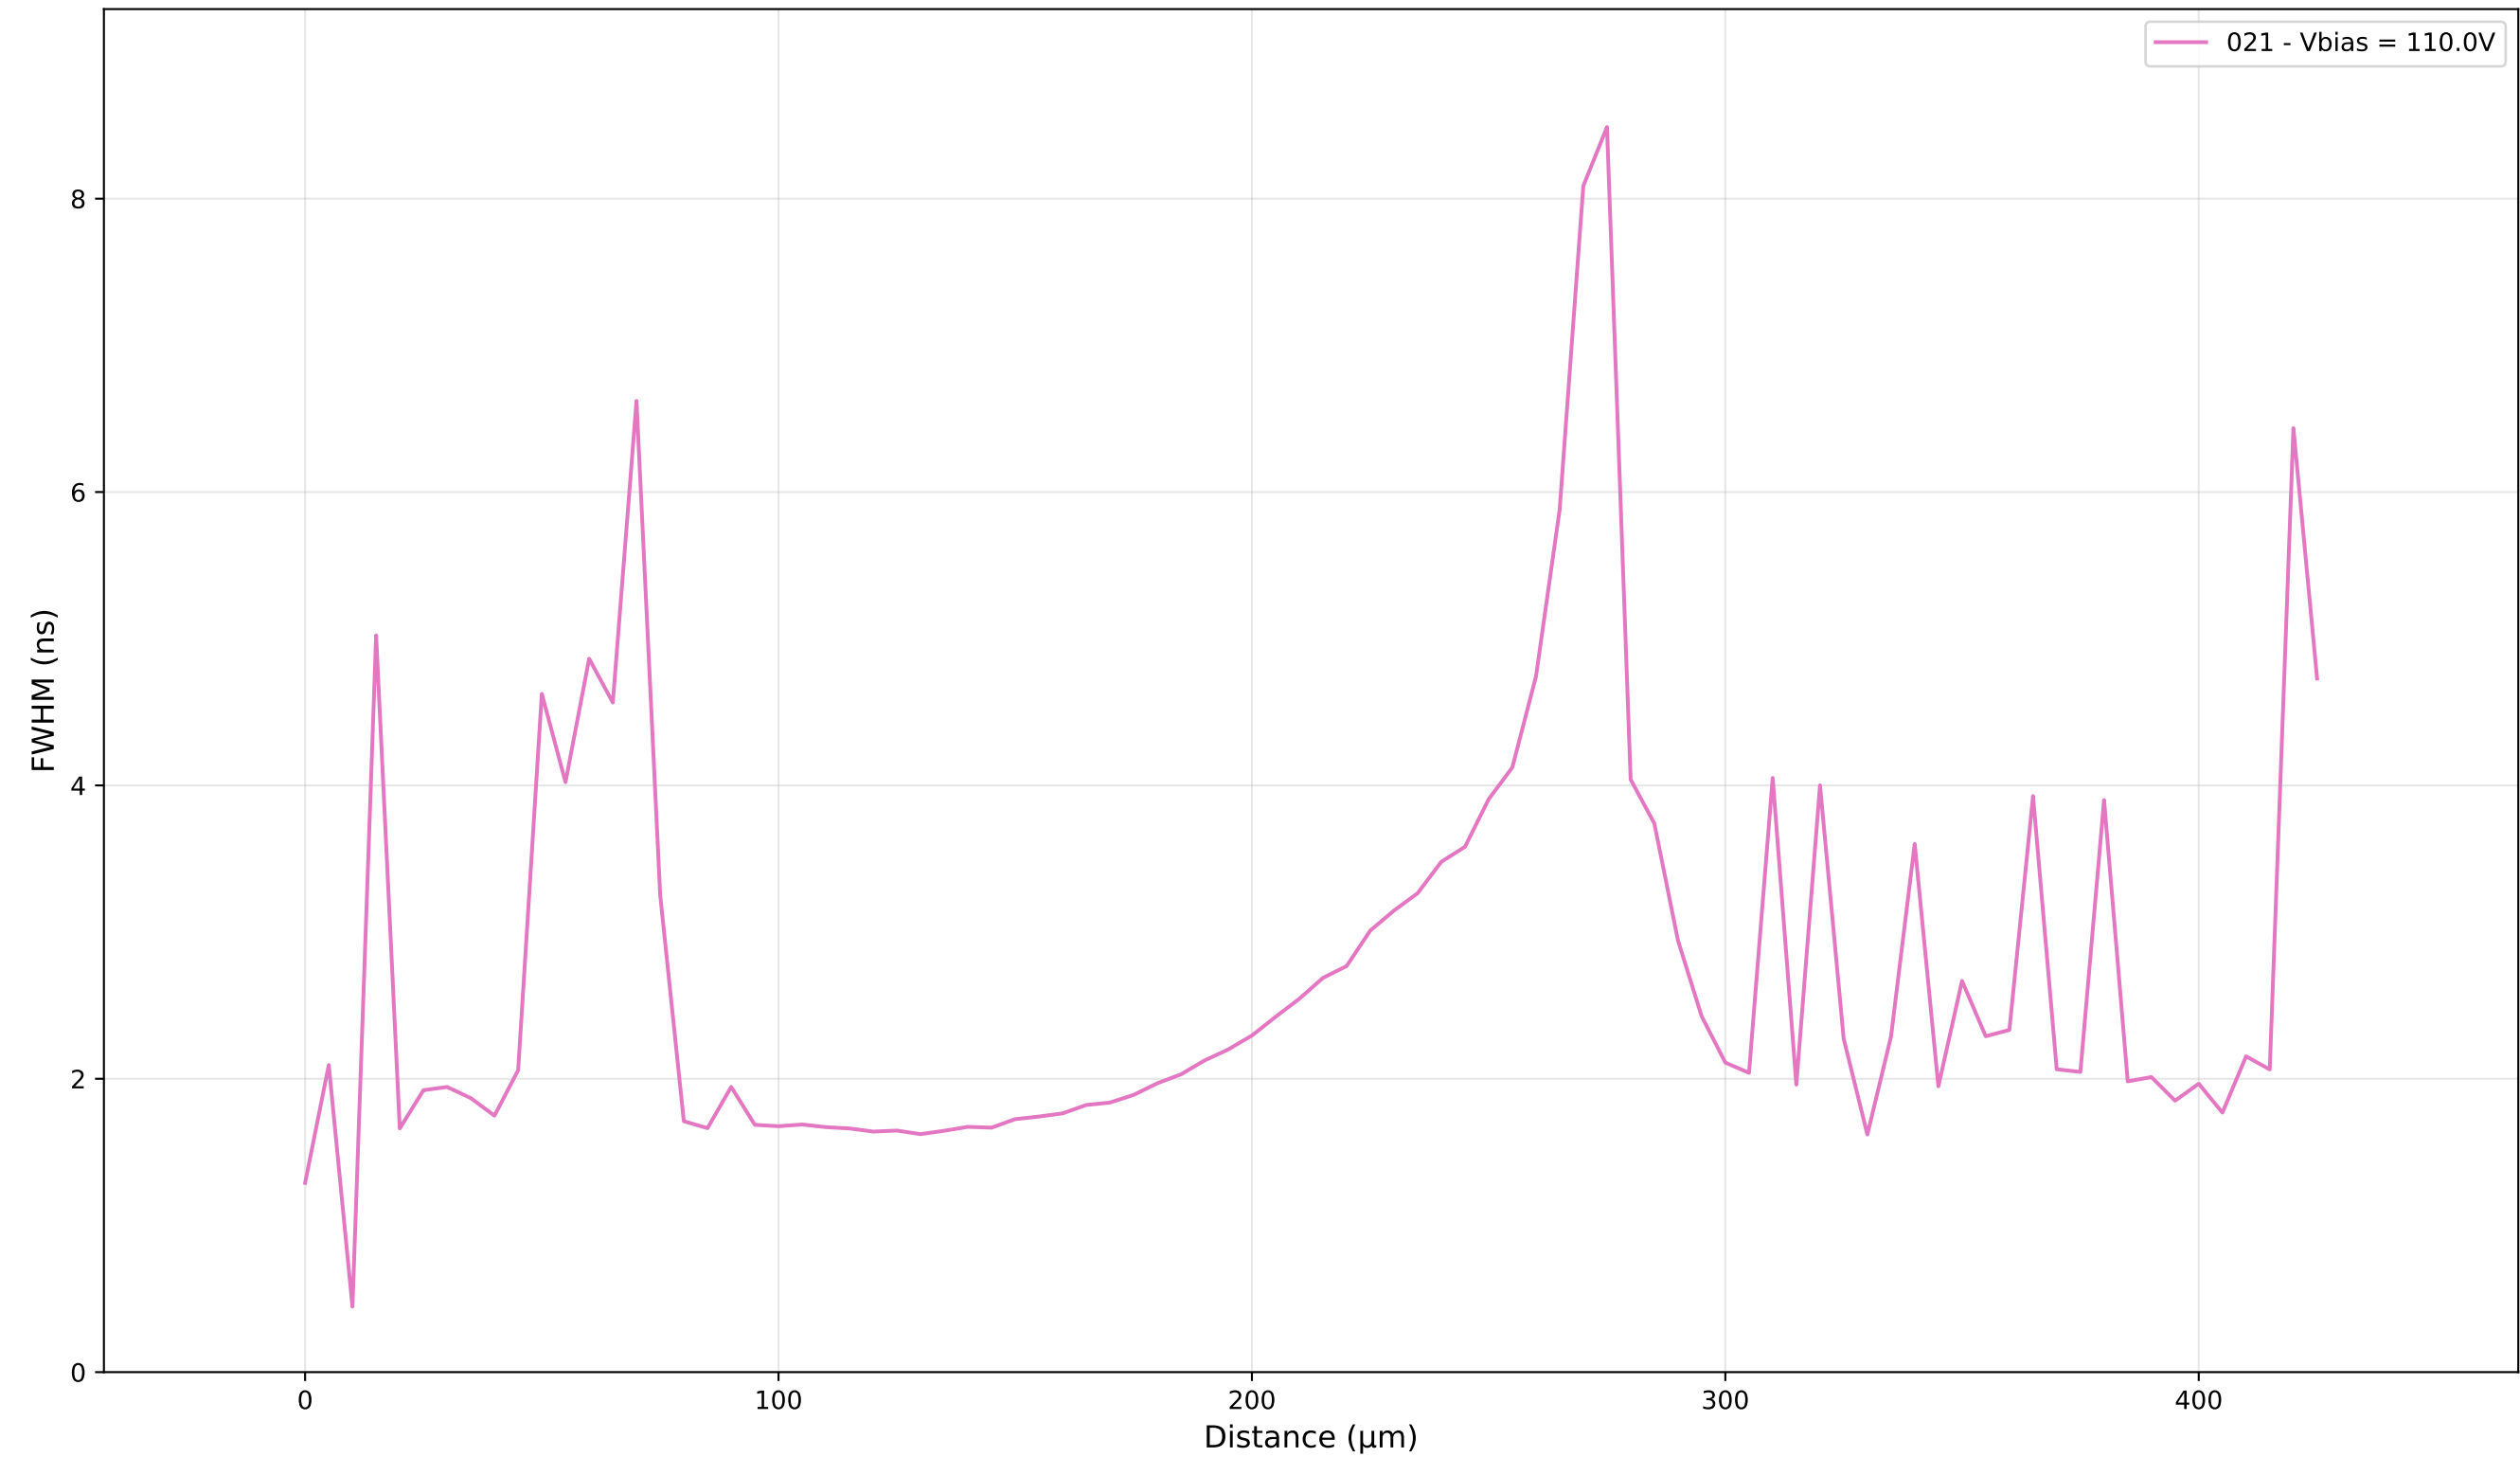


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 2.50 pC - Rise Time: 0.00 ns (N/A)

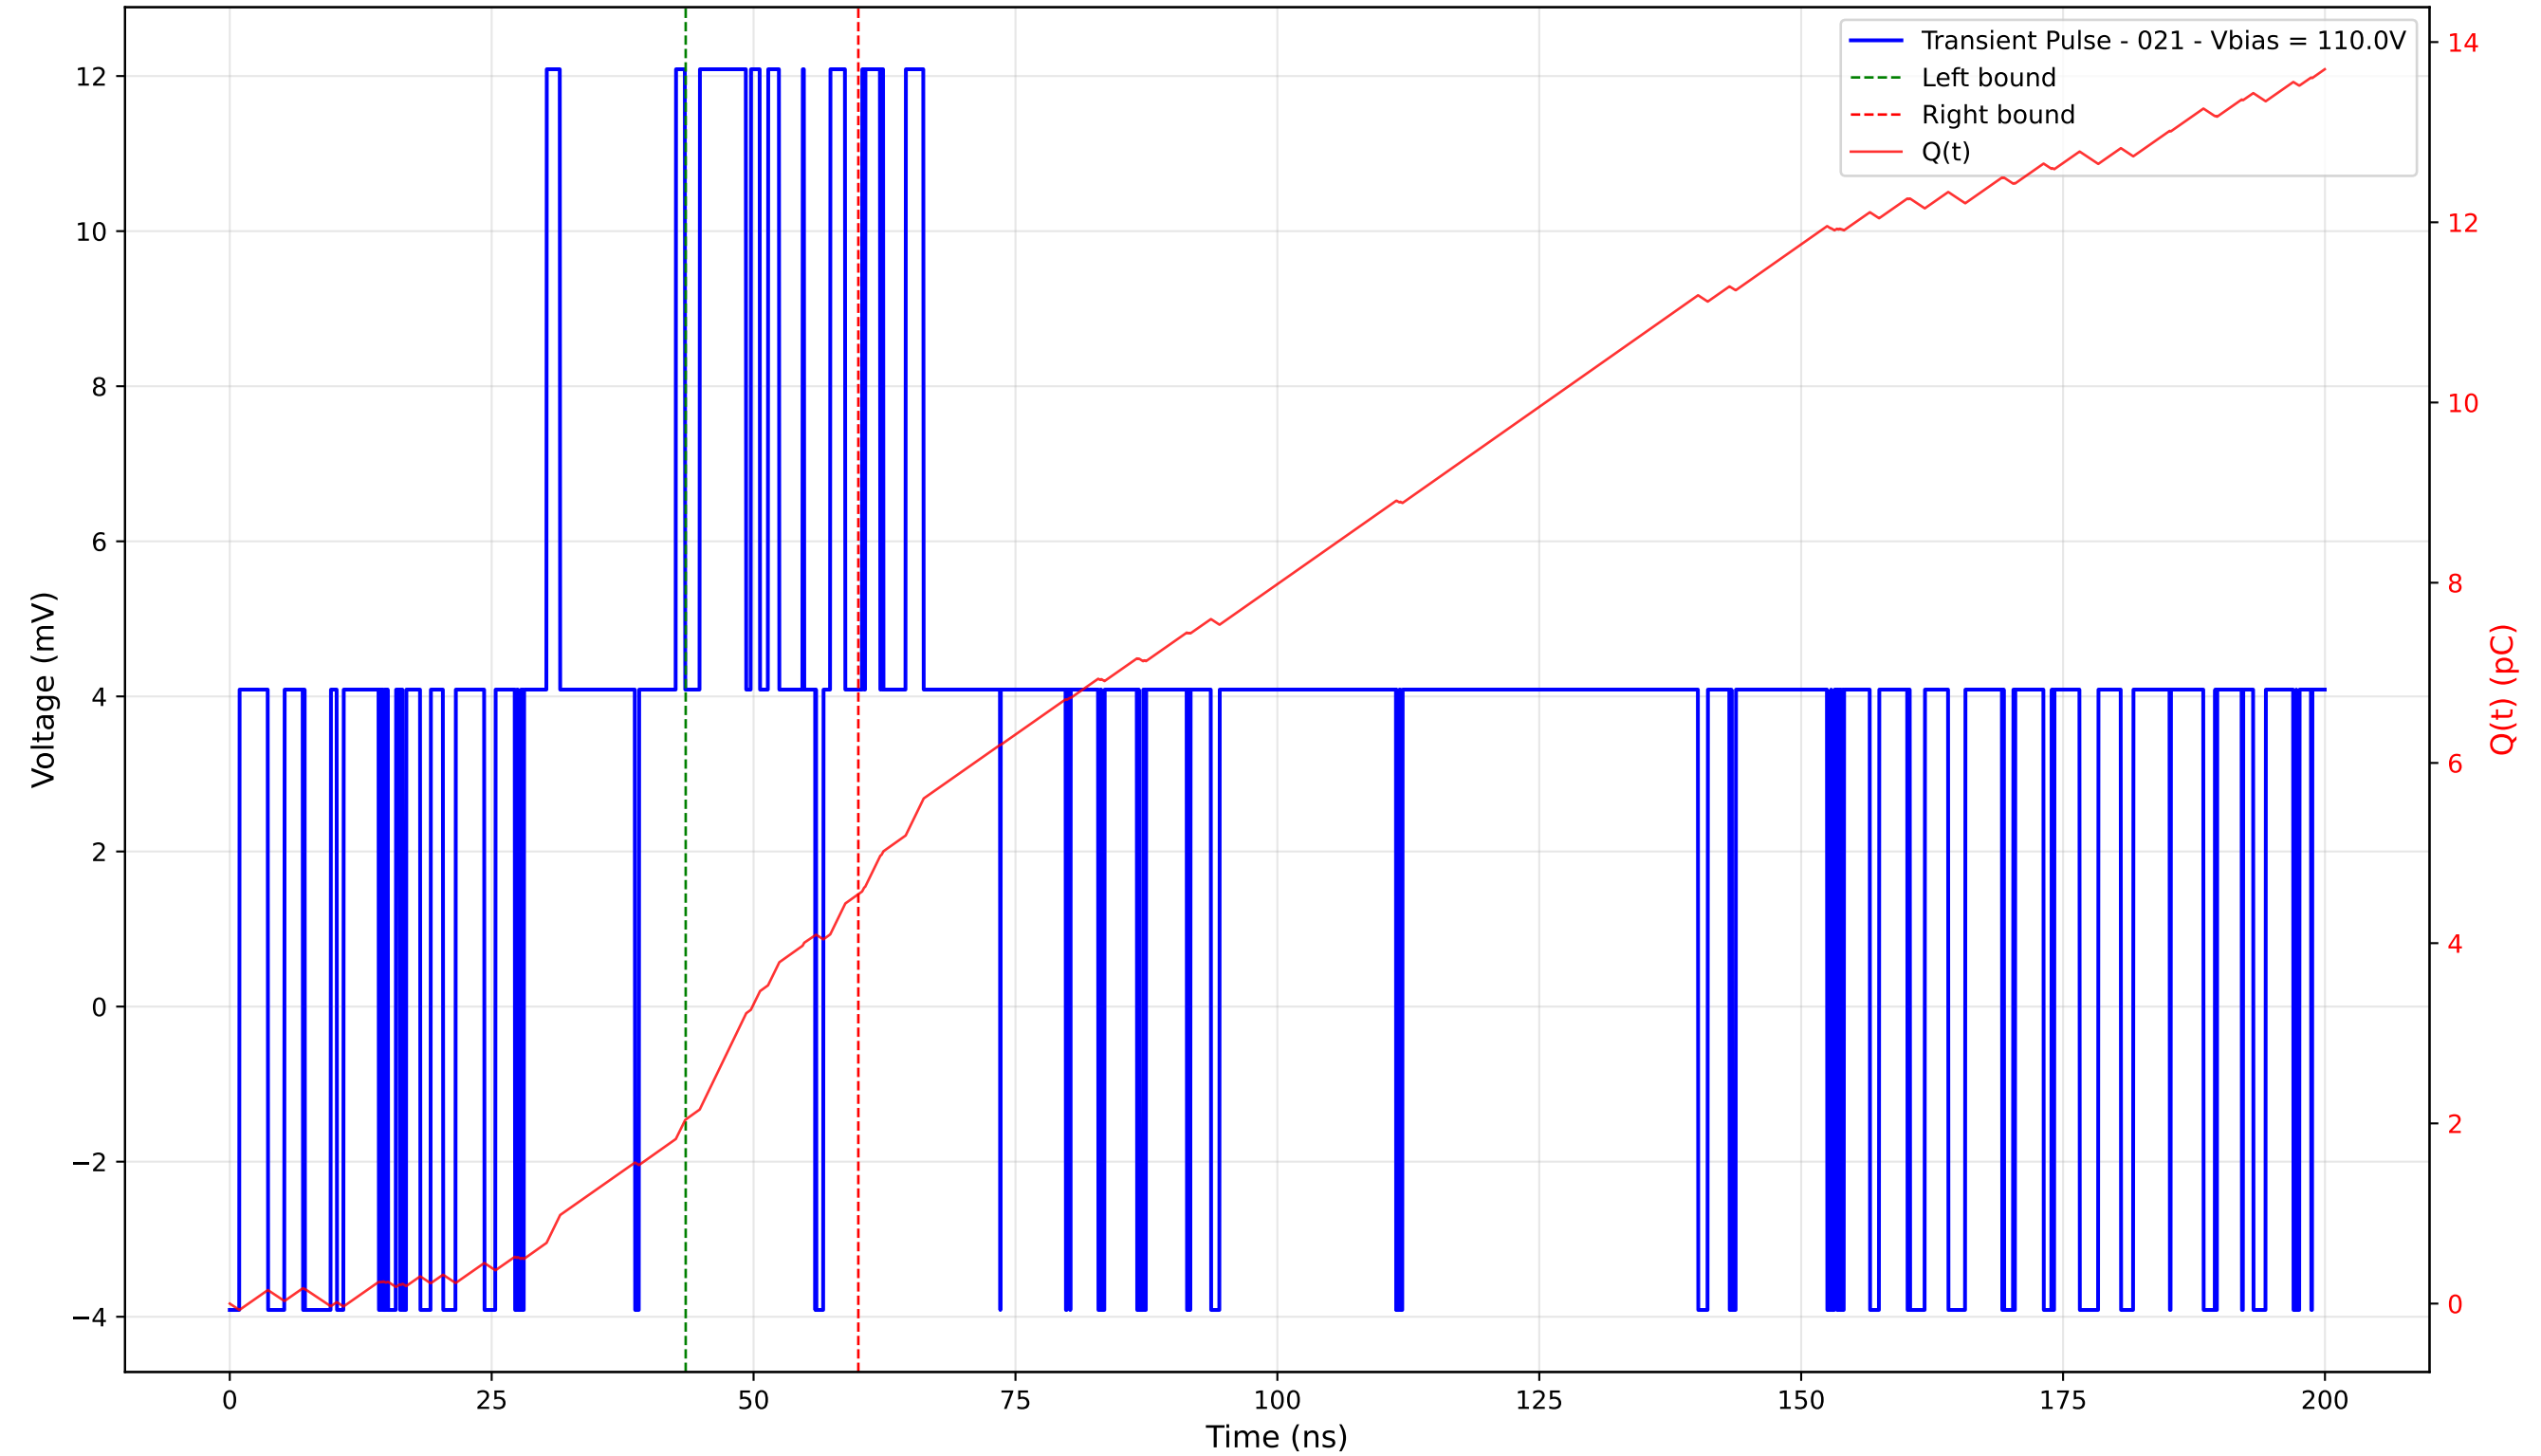


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 2.40 pC - Rise Time: 0.00 ns (N/A)

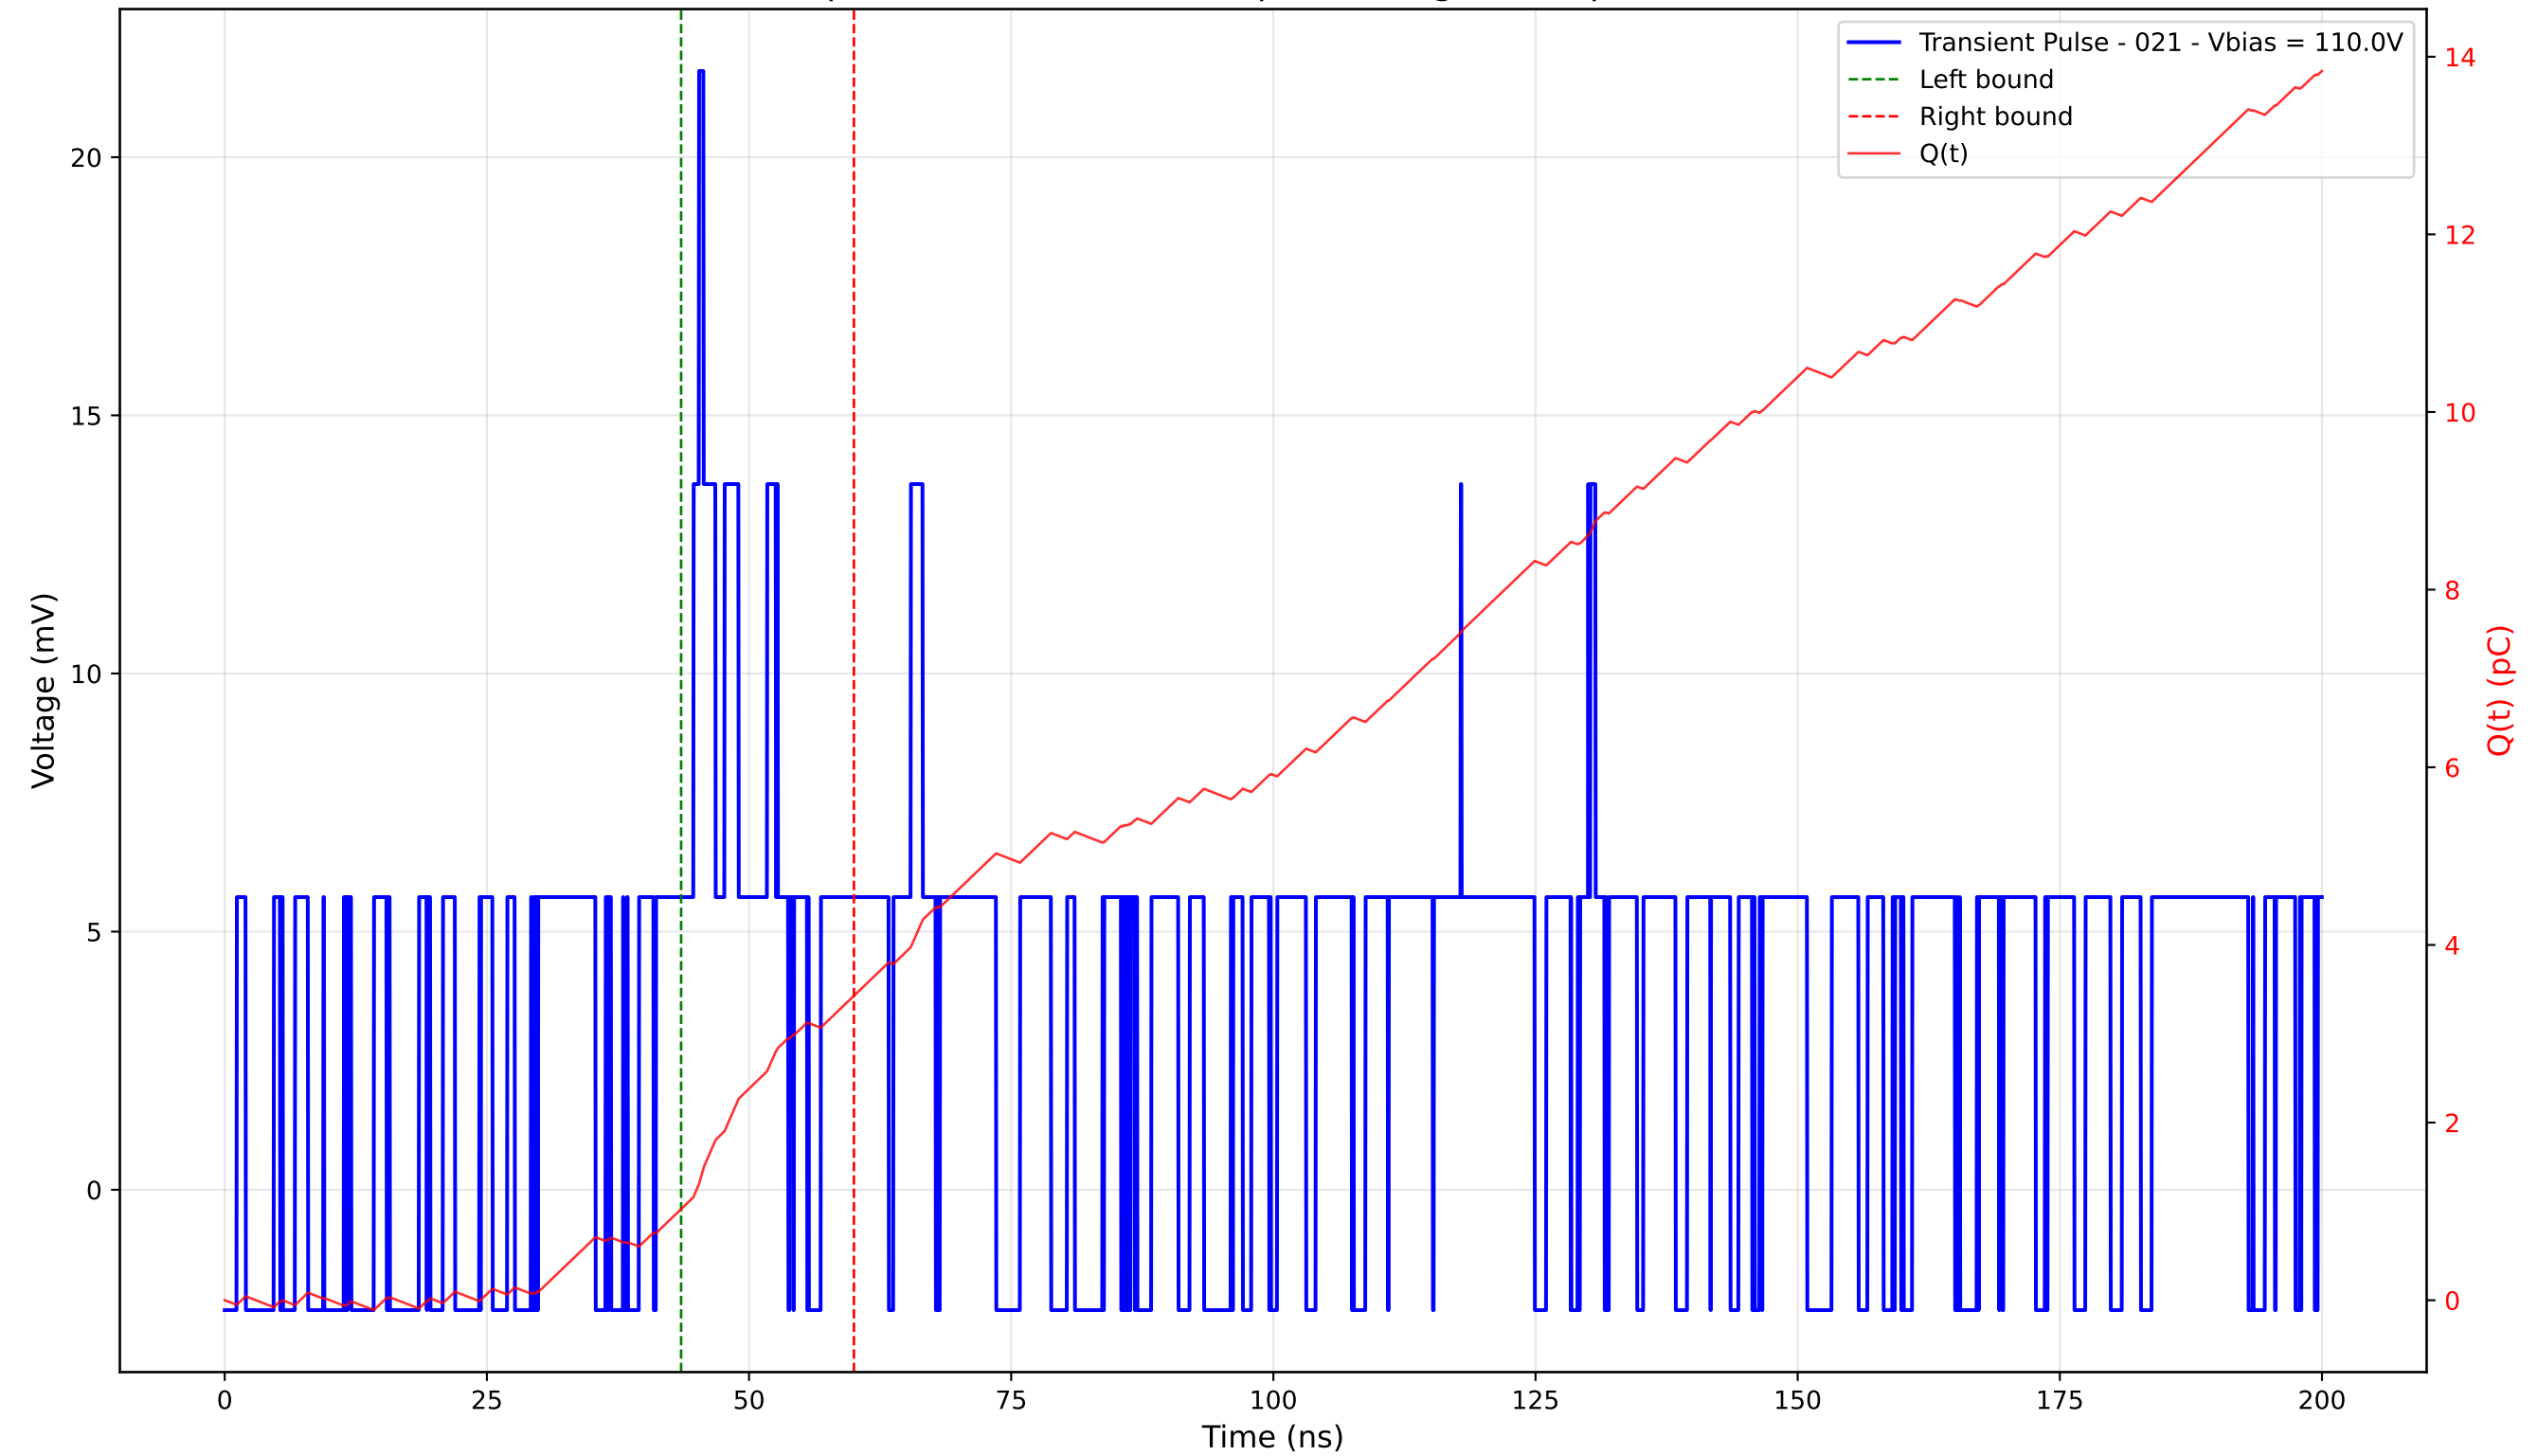


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 2.05 pC - Rise Time: 0.00 ns (N/A)

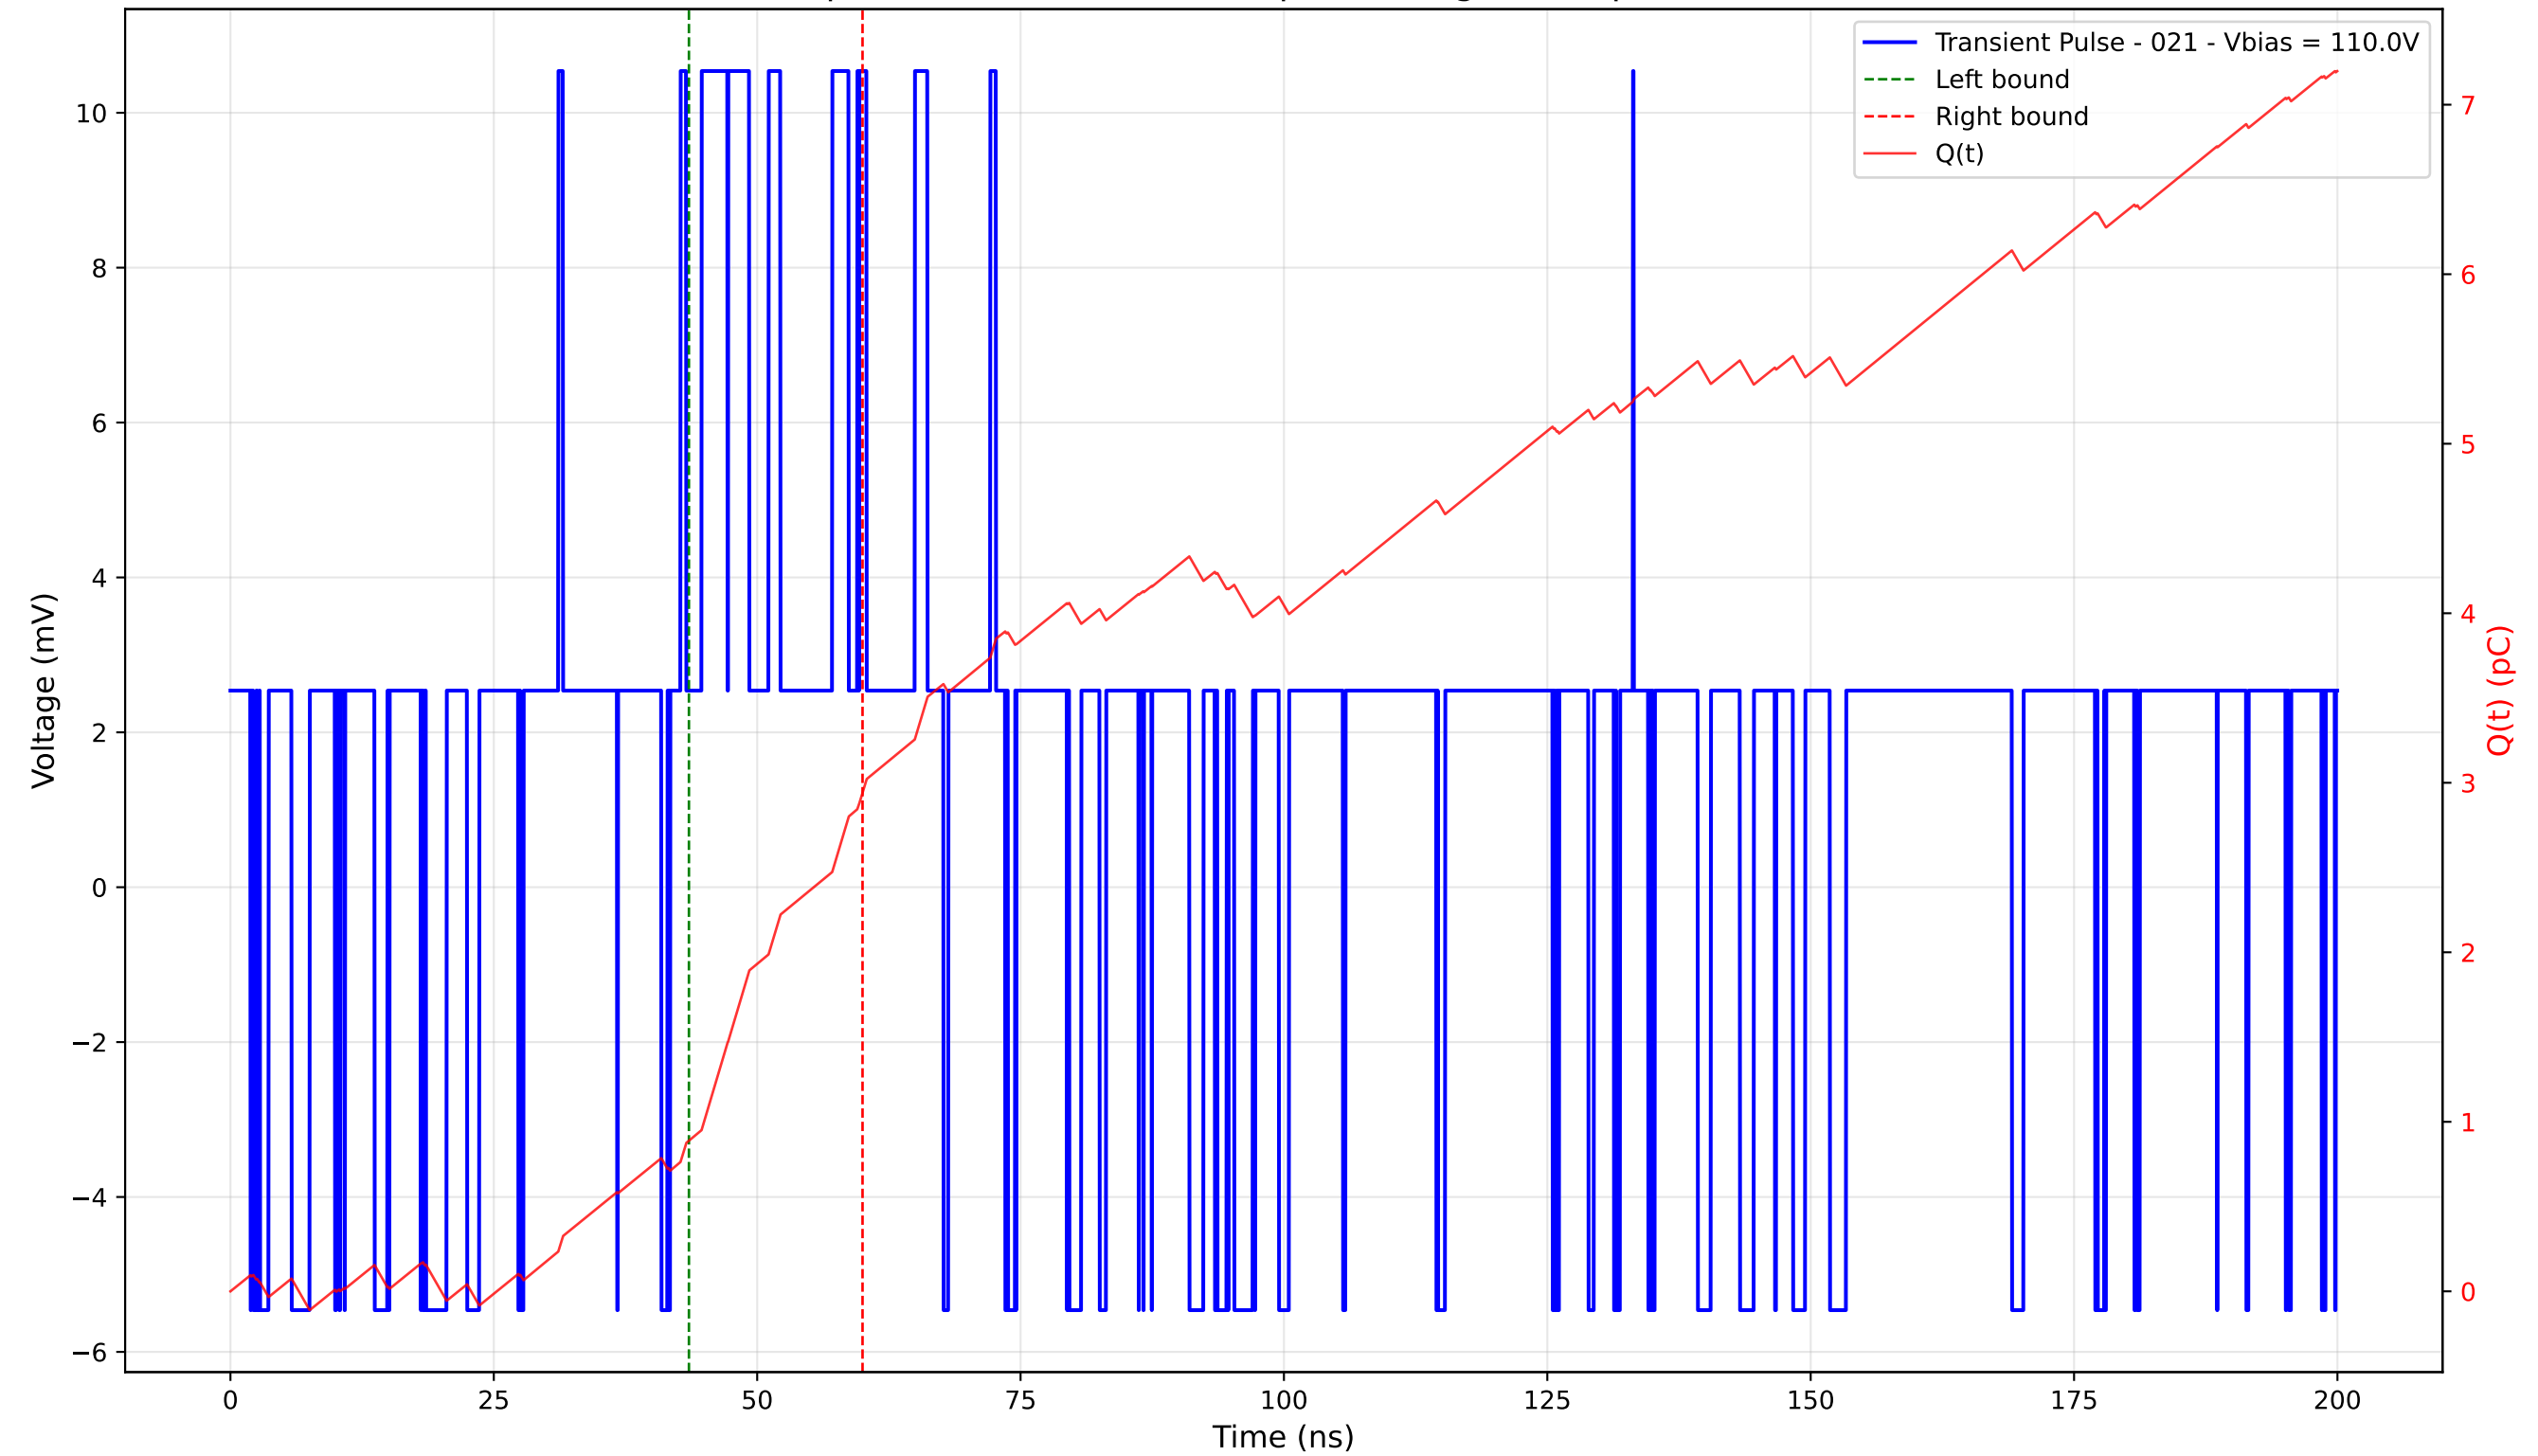


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 2.00 pC - Rise Time: 0.66 ns

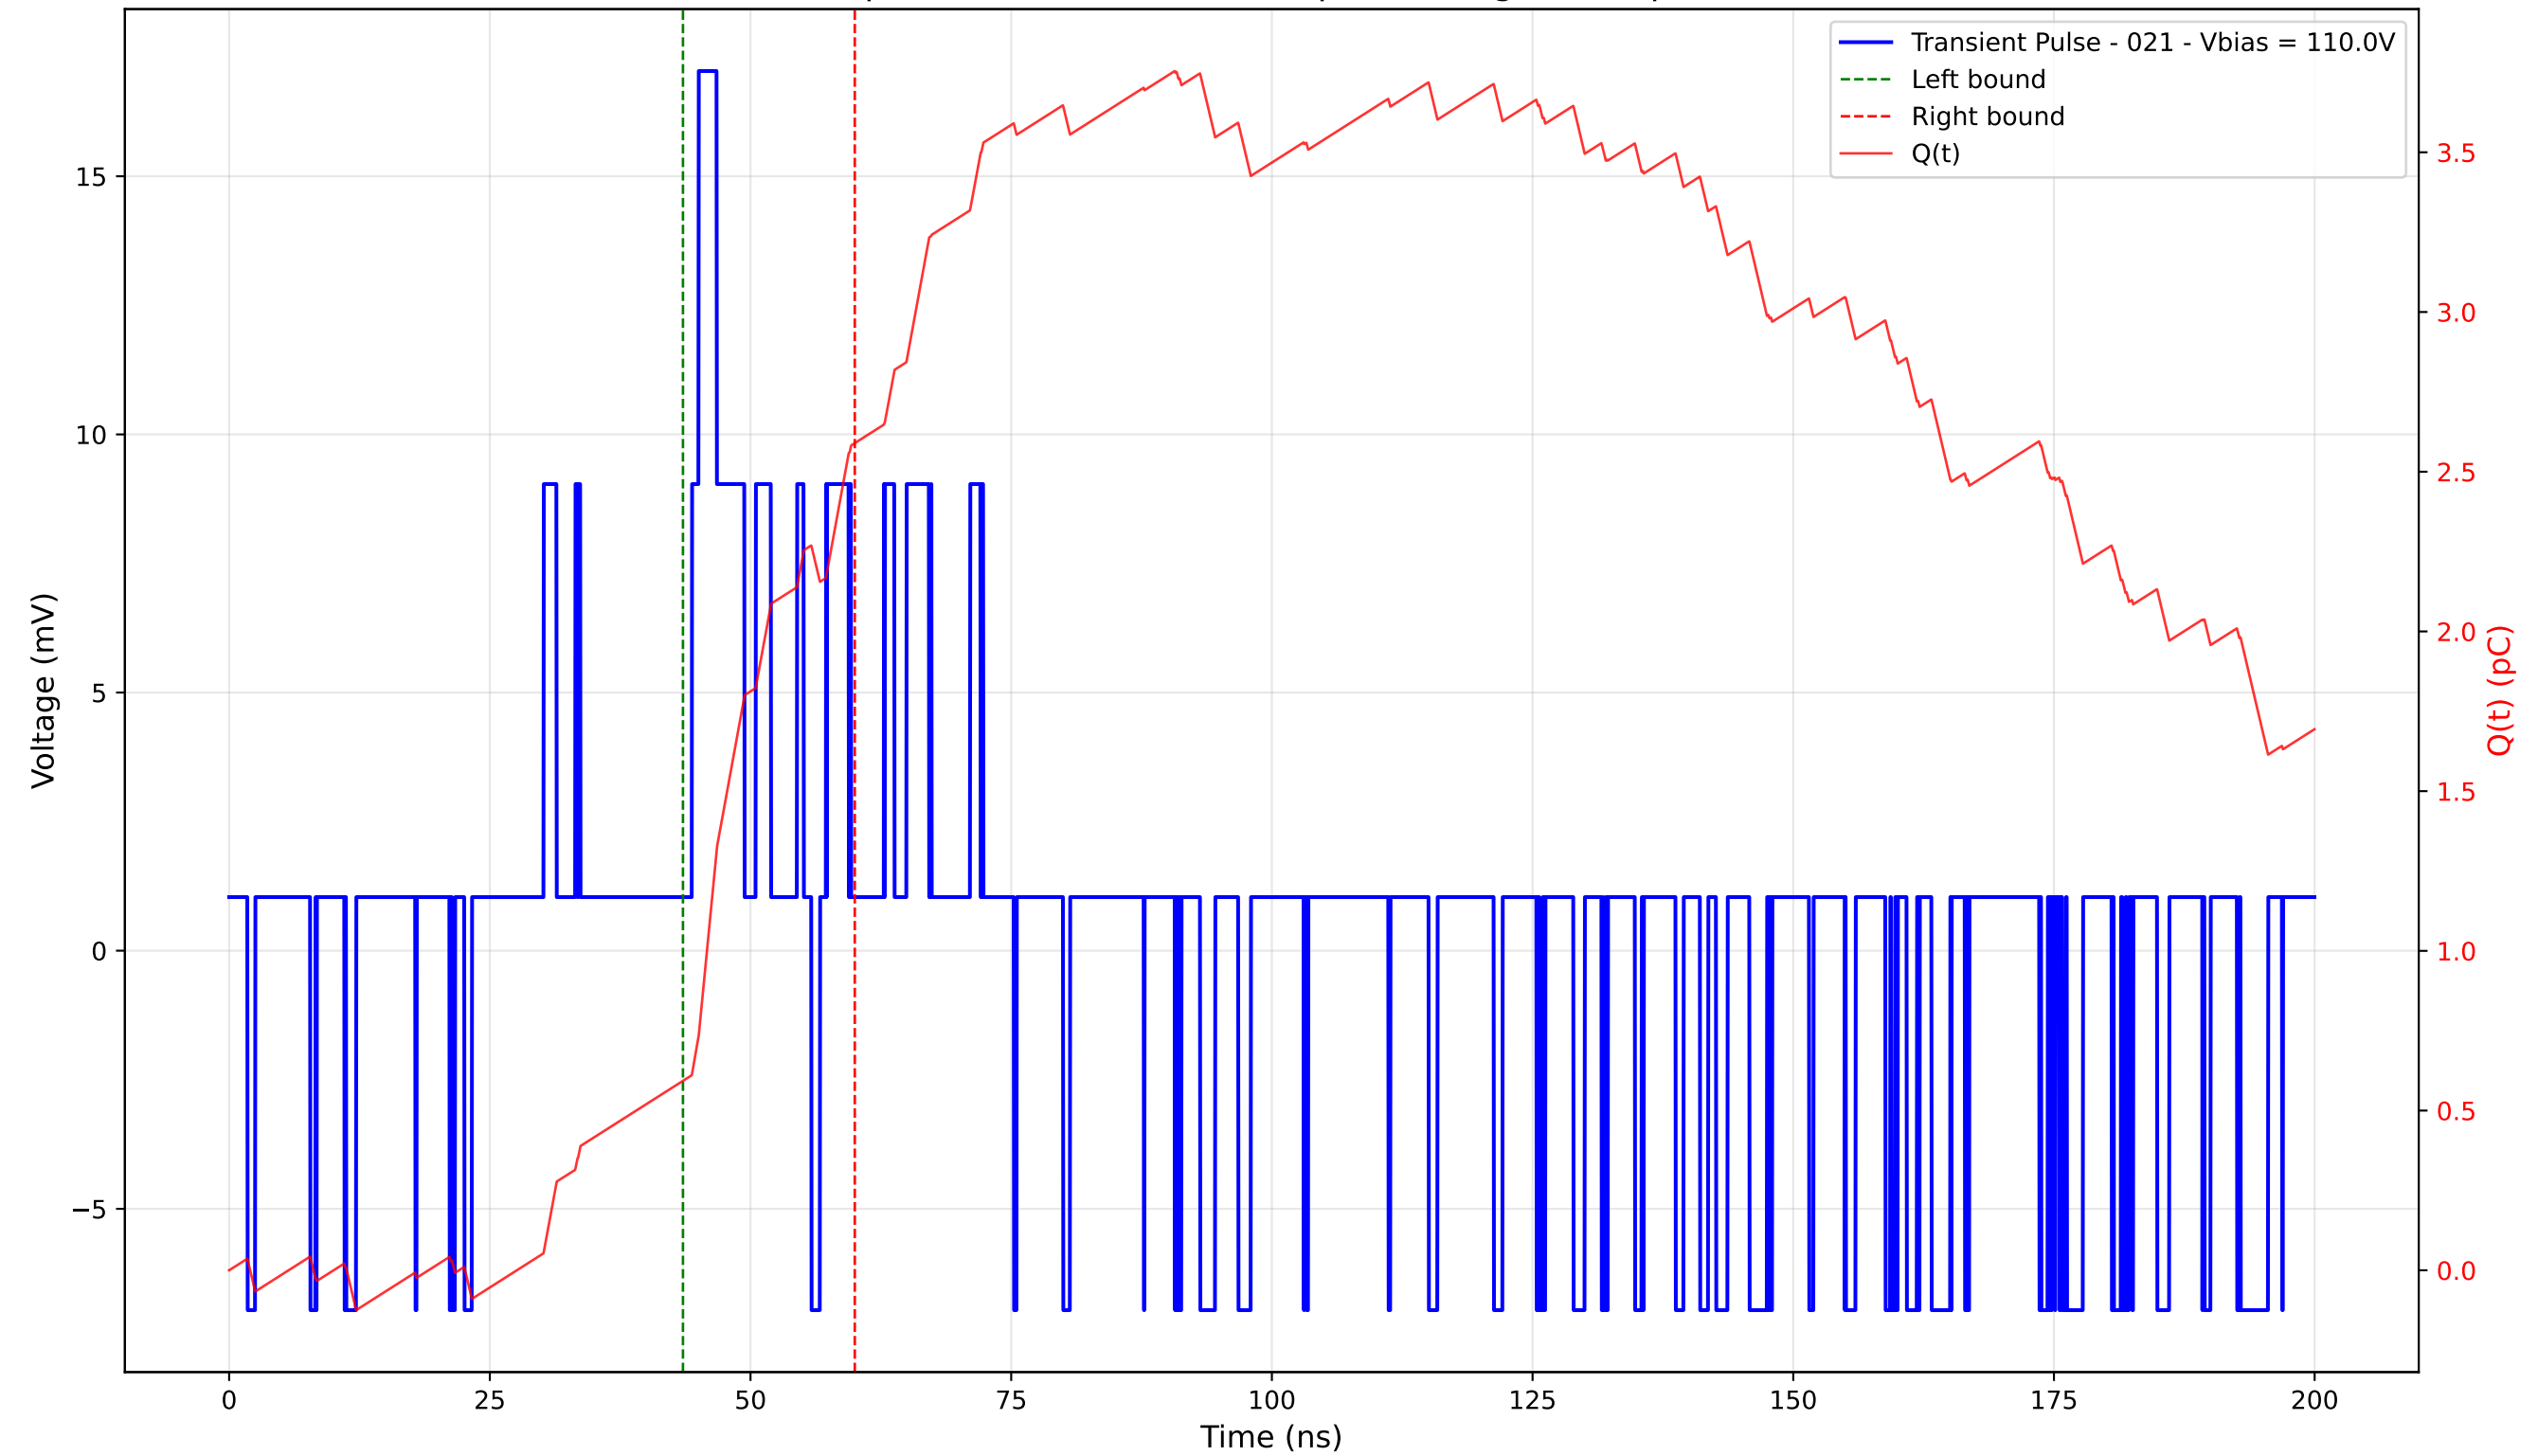


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 2.25 pC - Rise Time: 0.90 ns

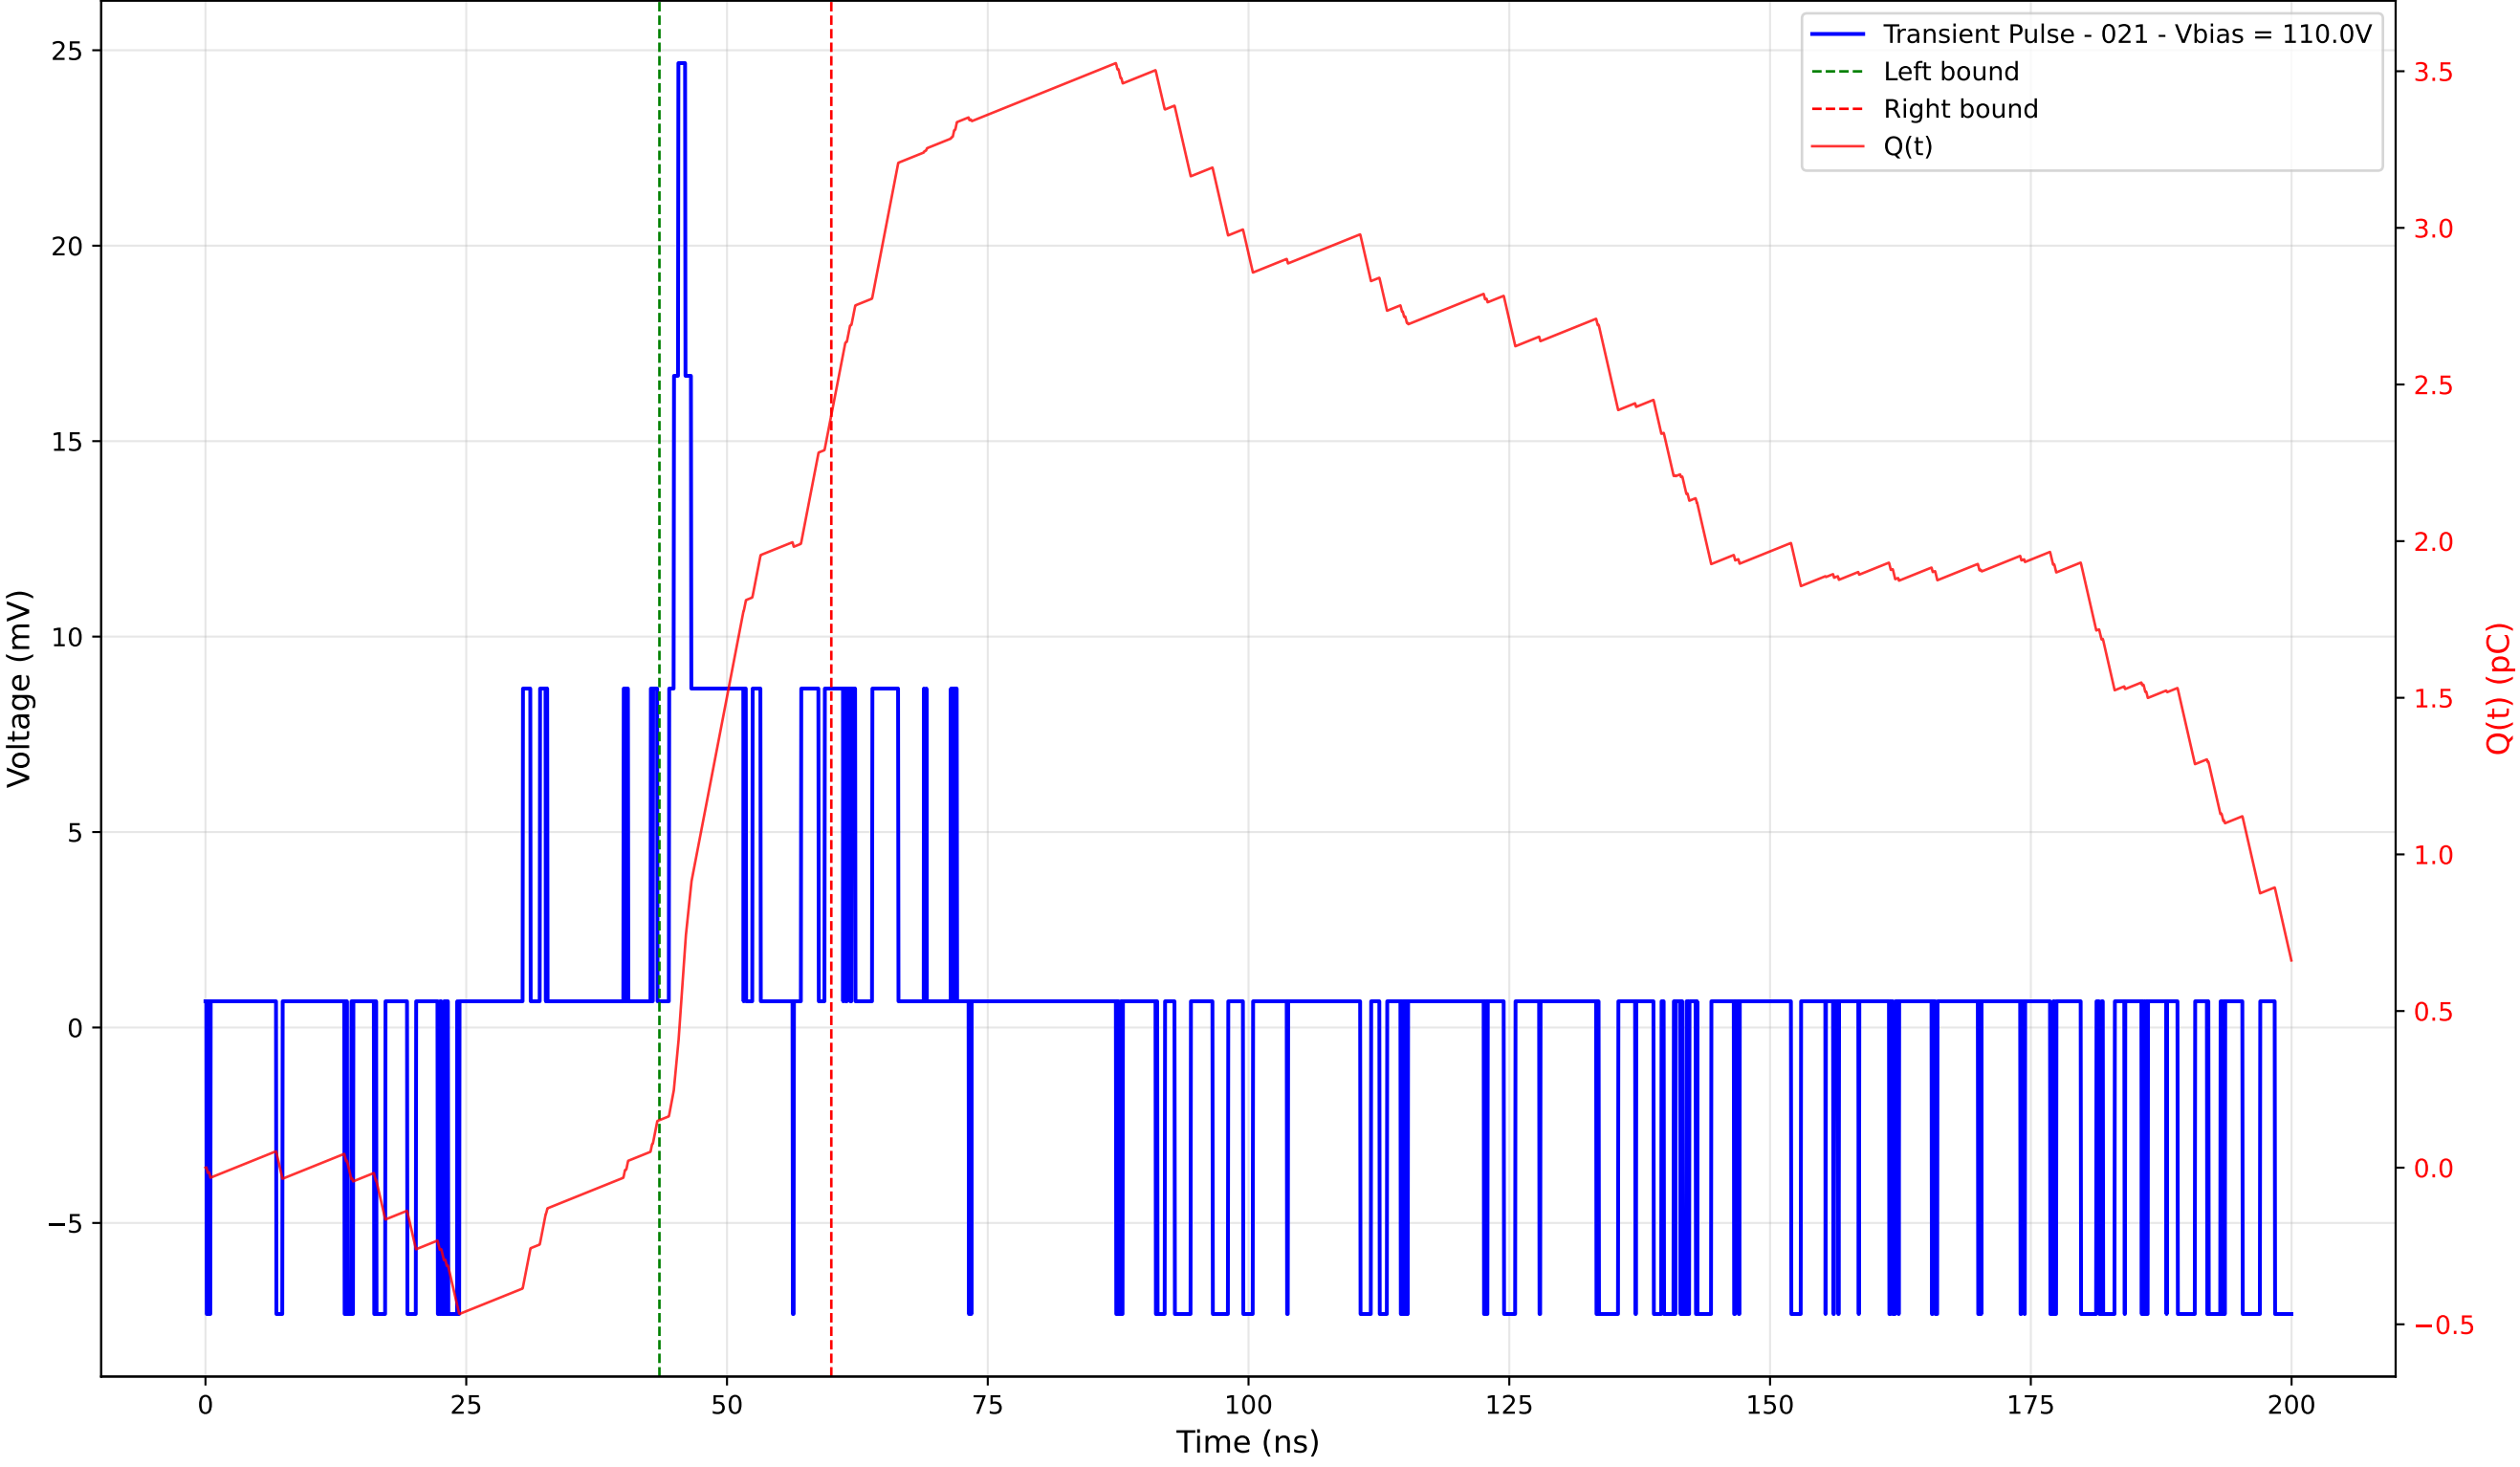


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.81 pC - Rise Time: 1.02 ns

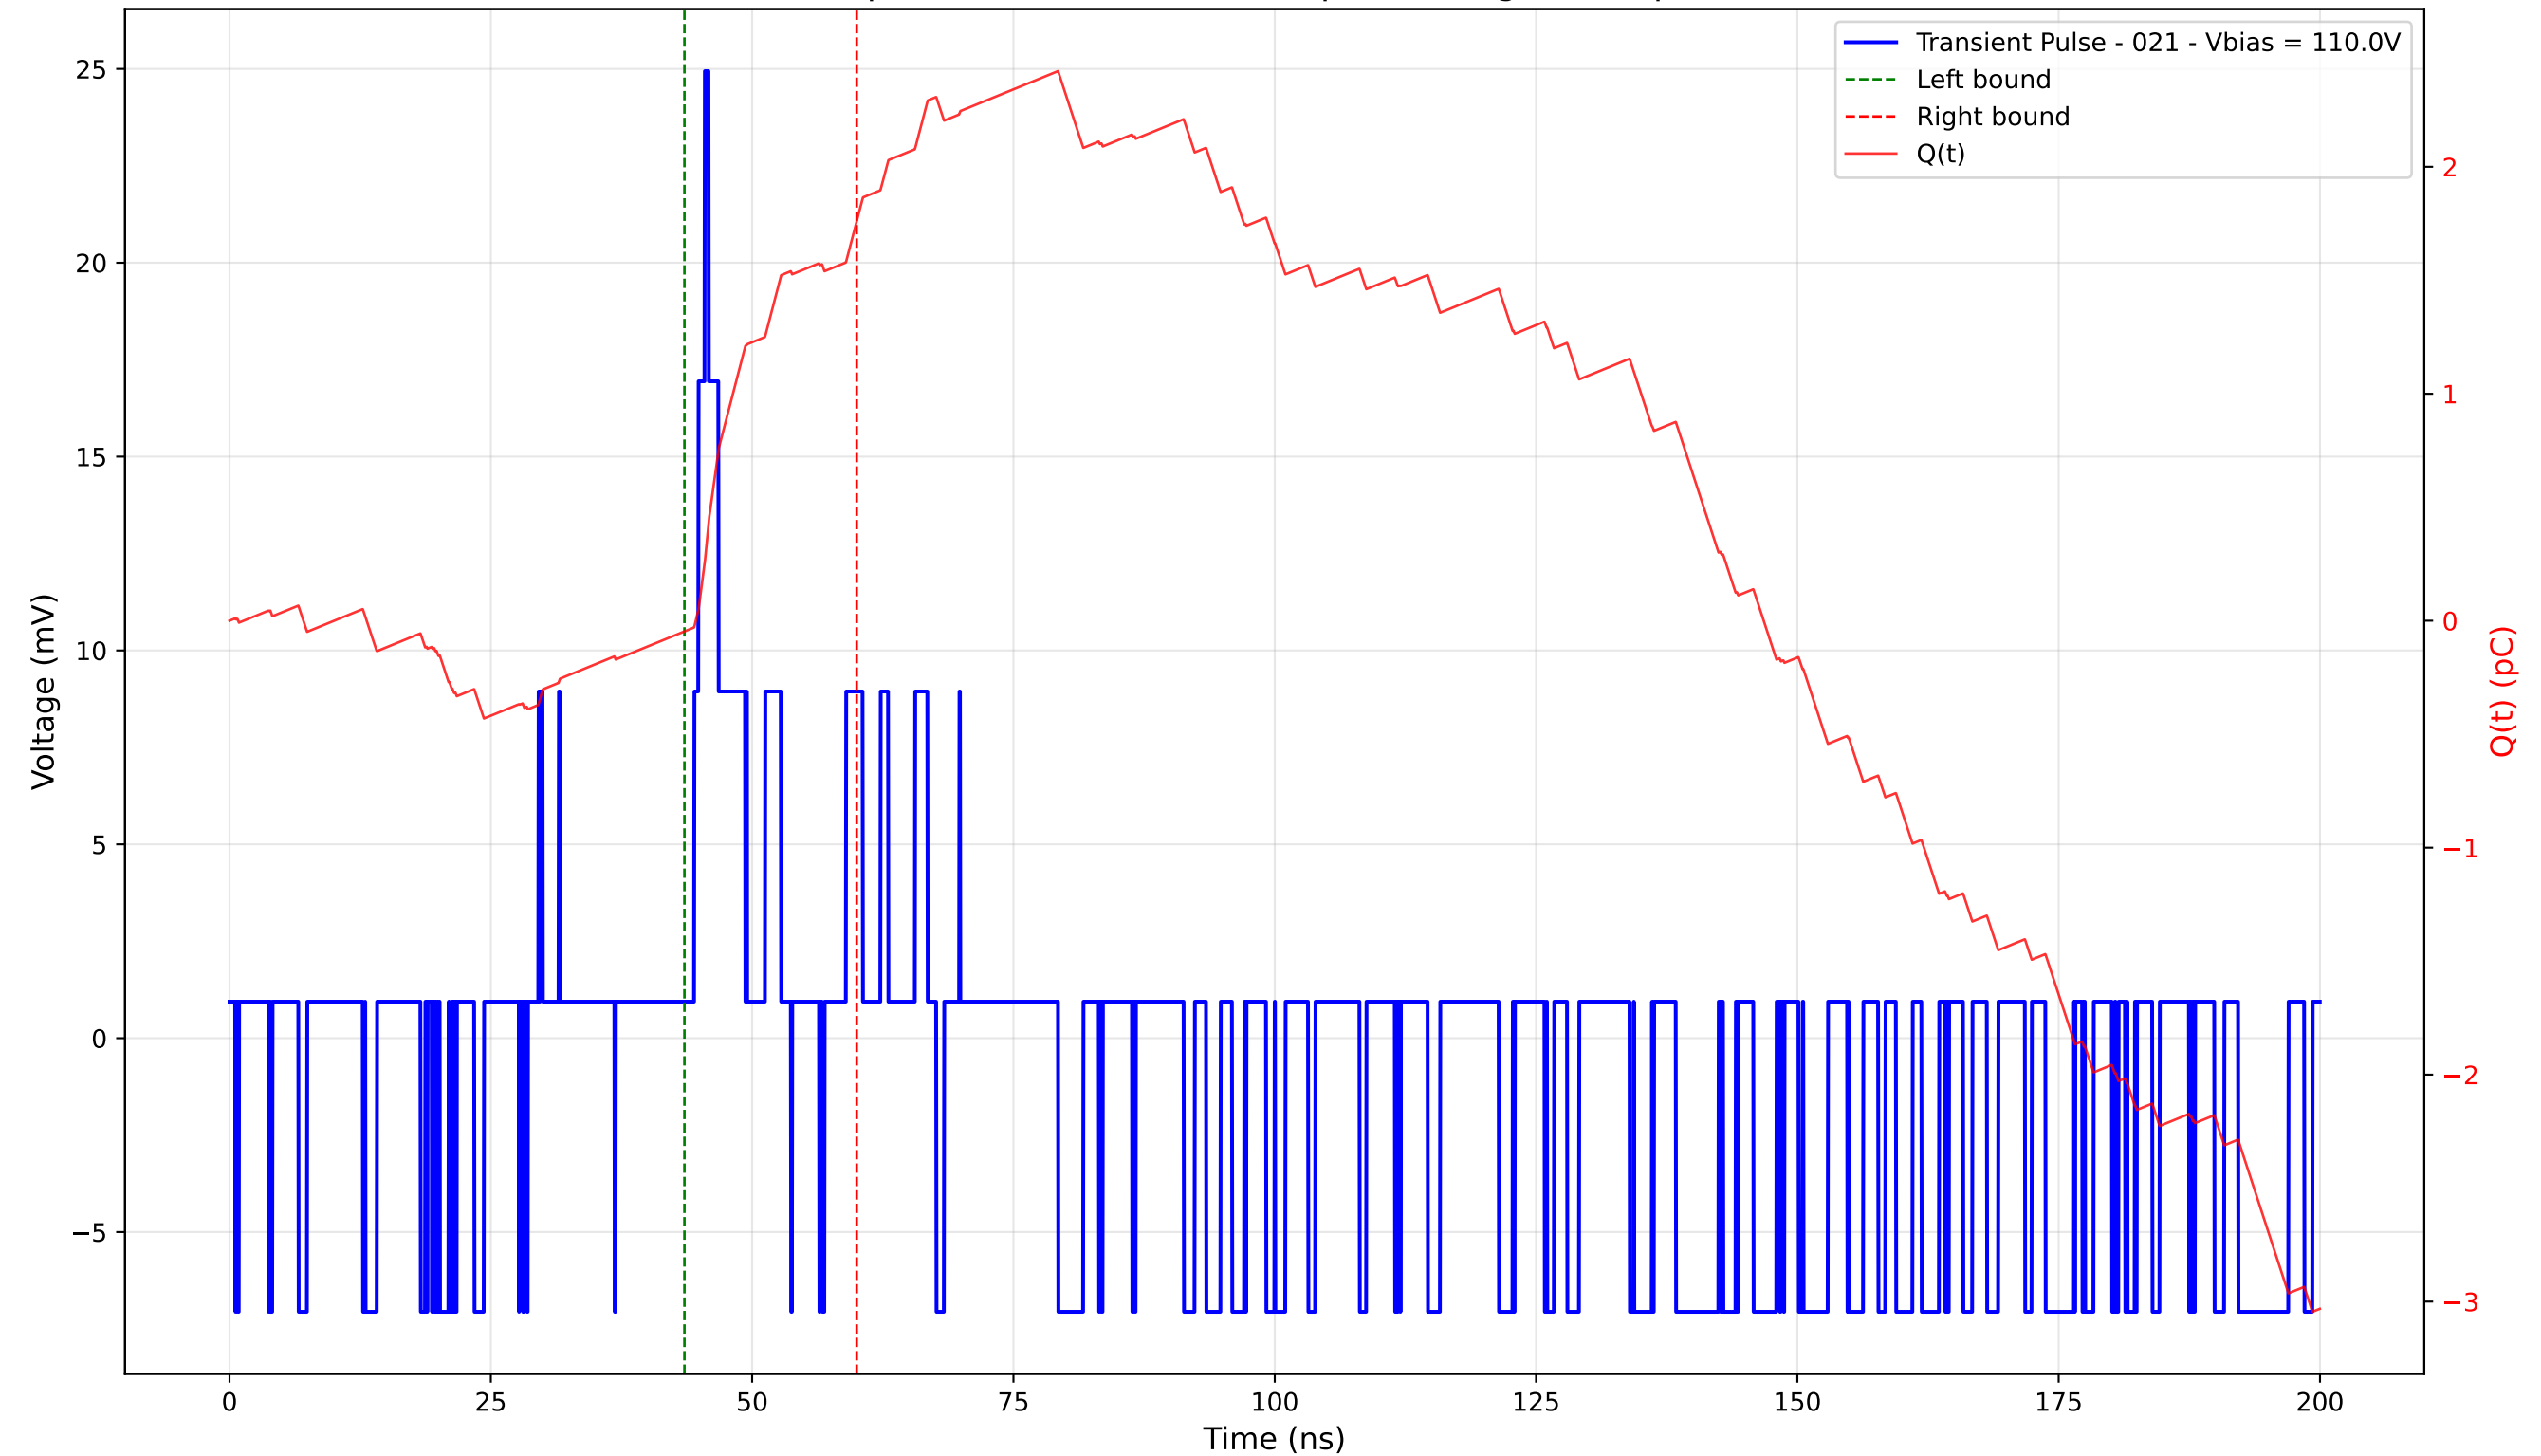


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 2.33 pC - Rise Time: 1.00 ns

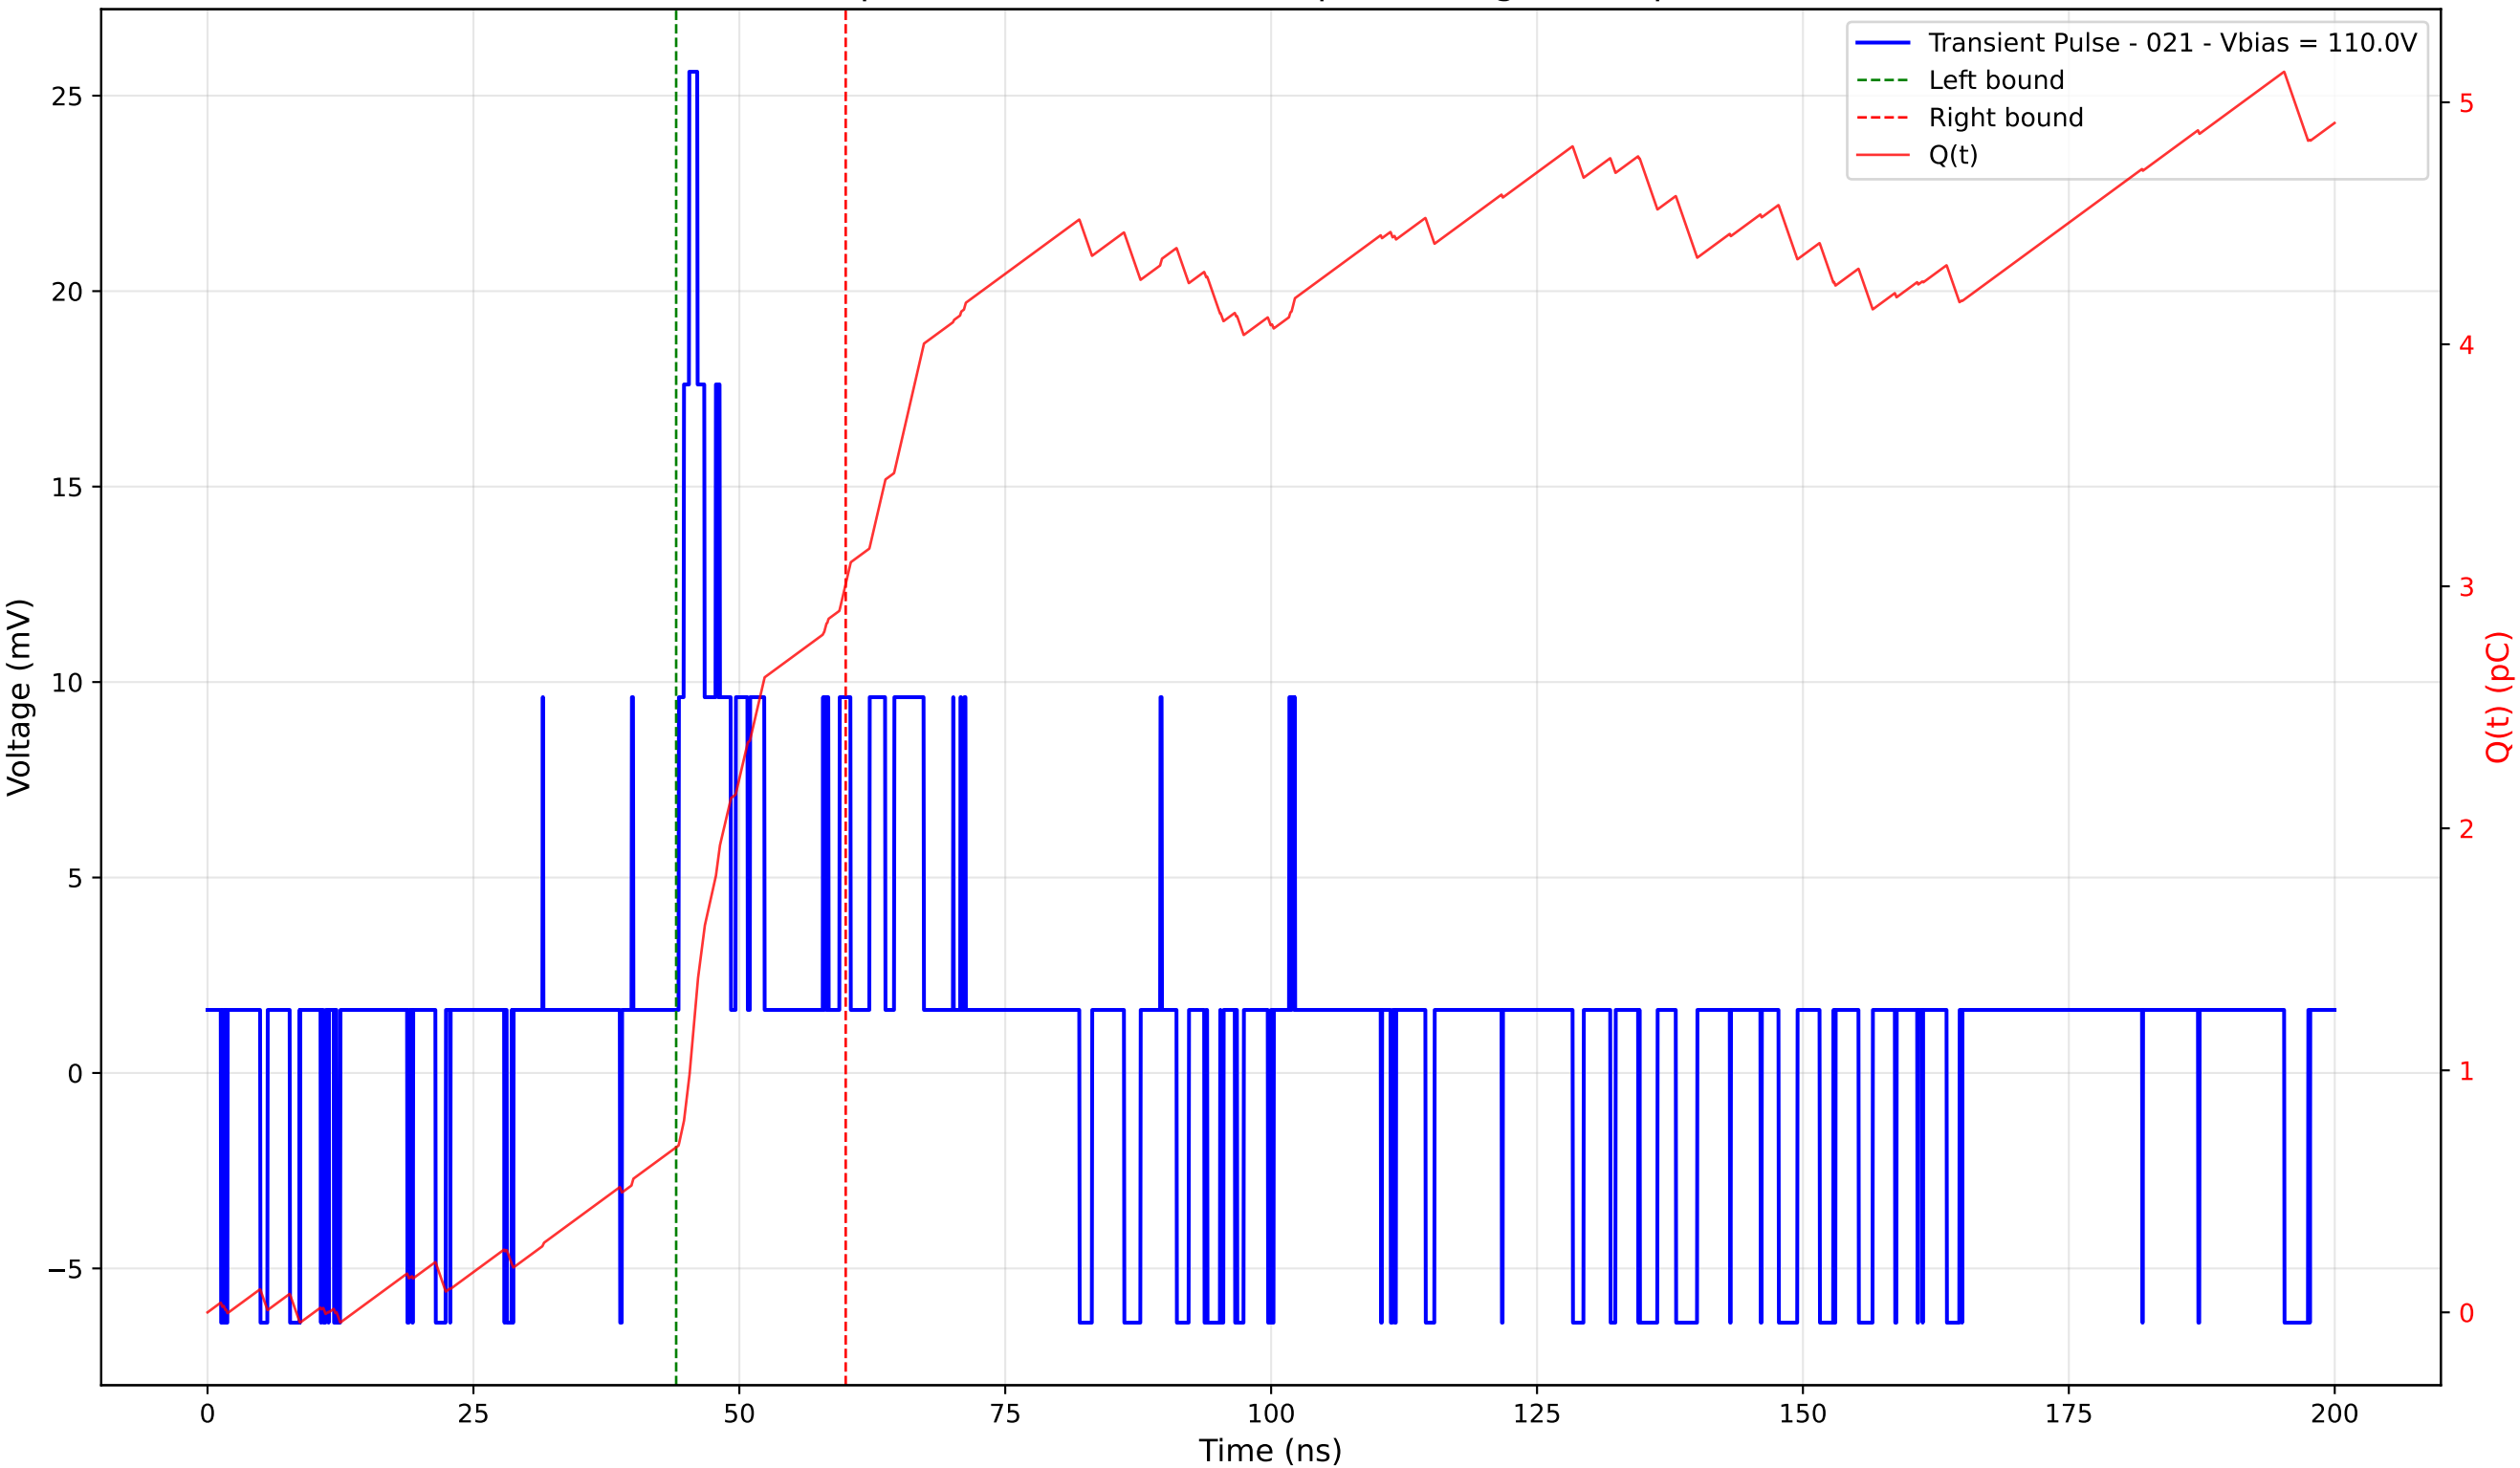


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 2.47 pC - Rise Time: 0.00 ns (N/A)

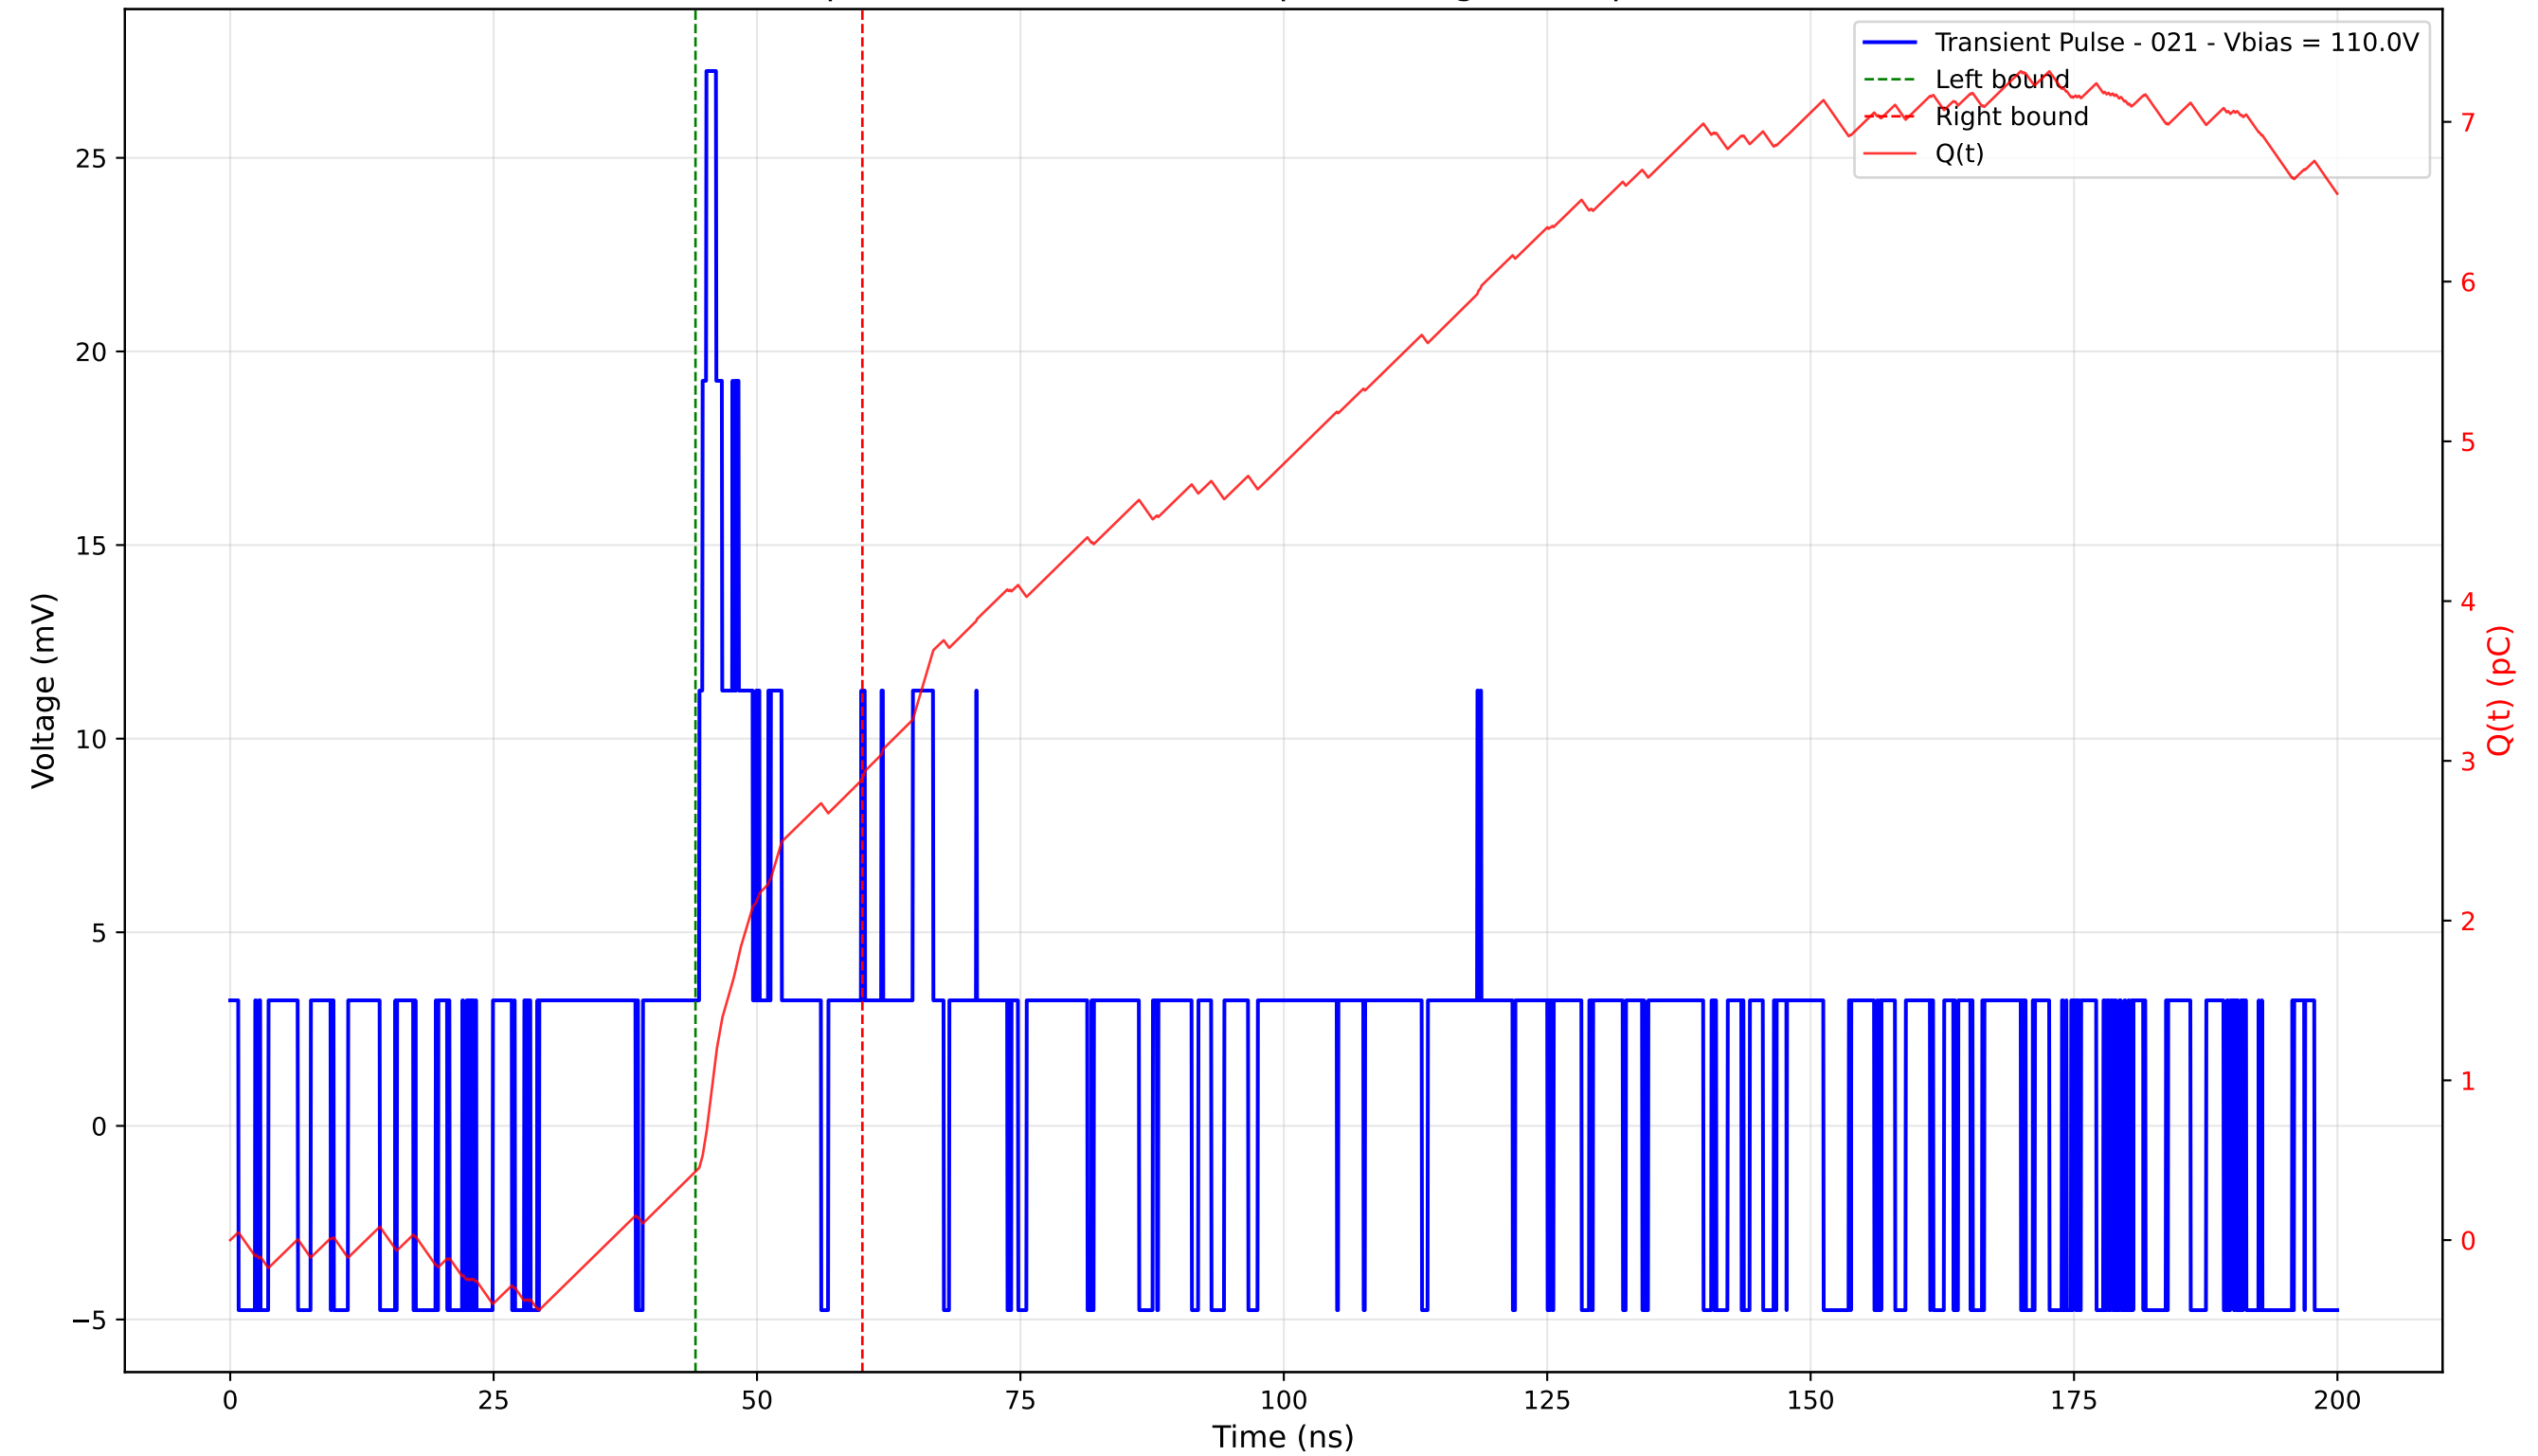


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.96 pC - Rise Time: 0.00 ns (N/A)

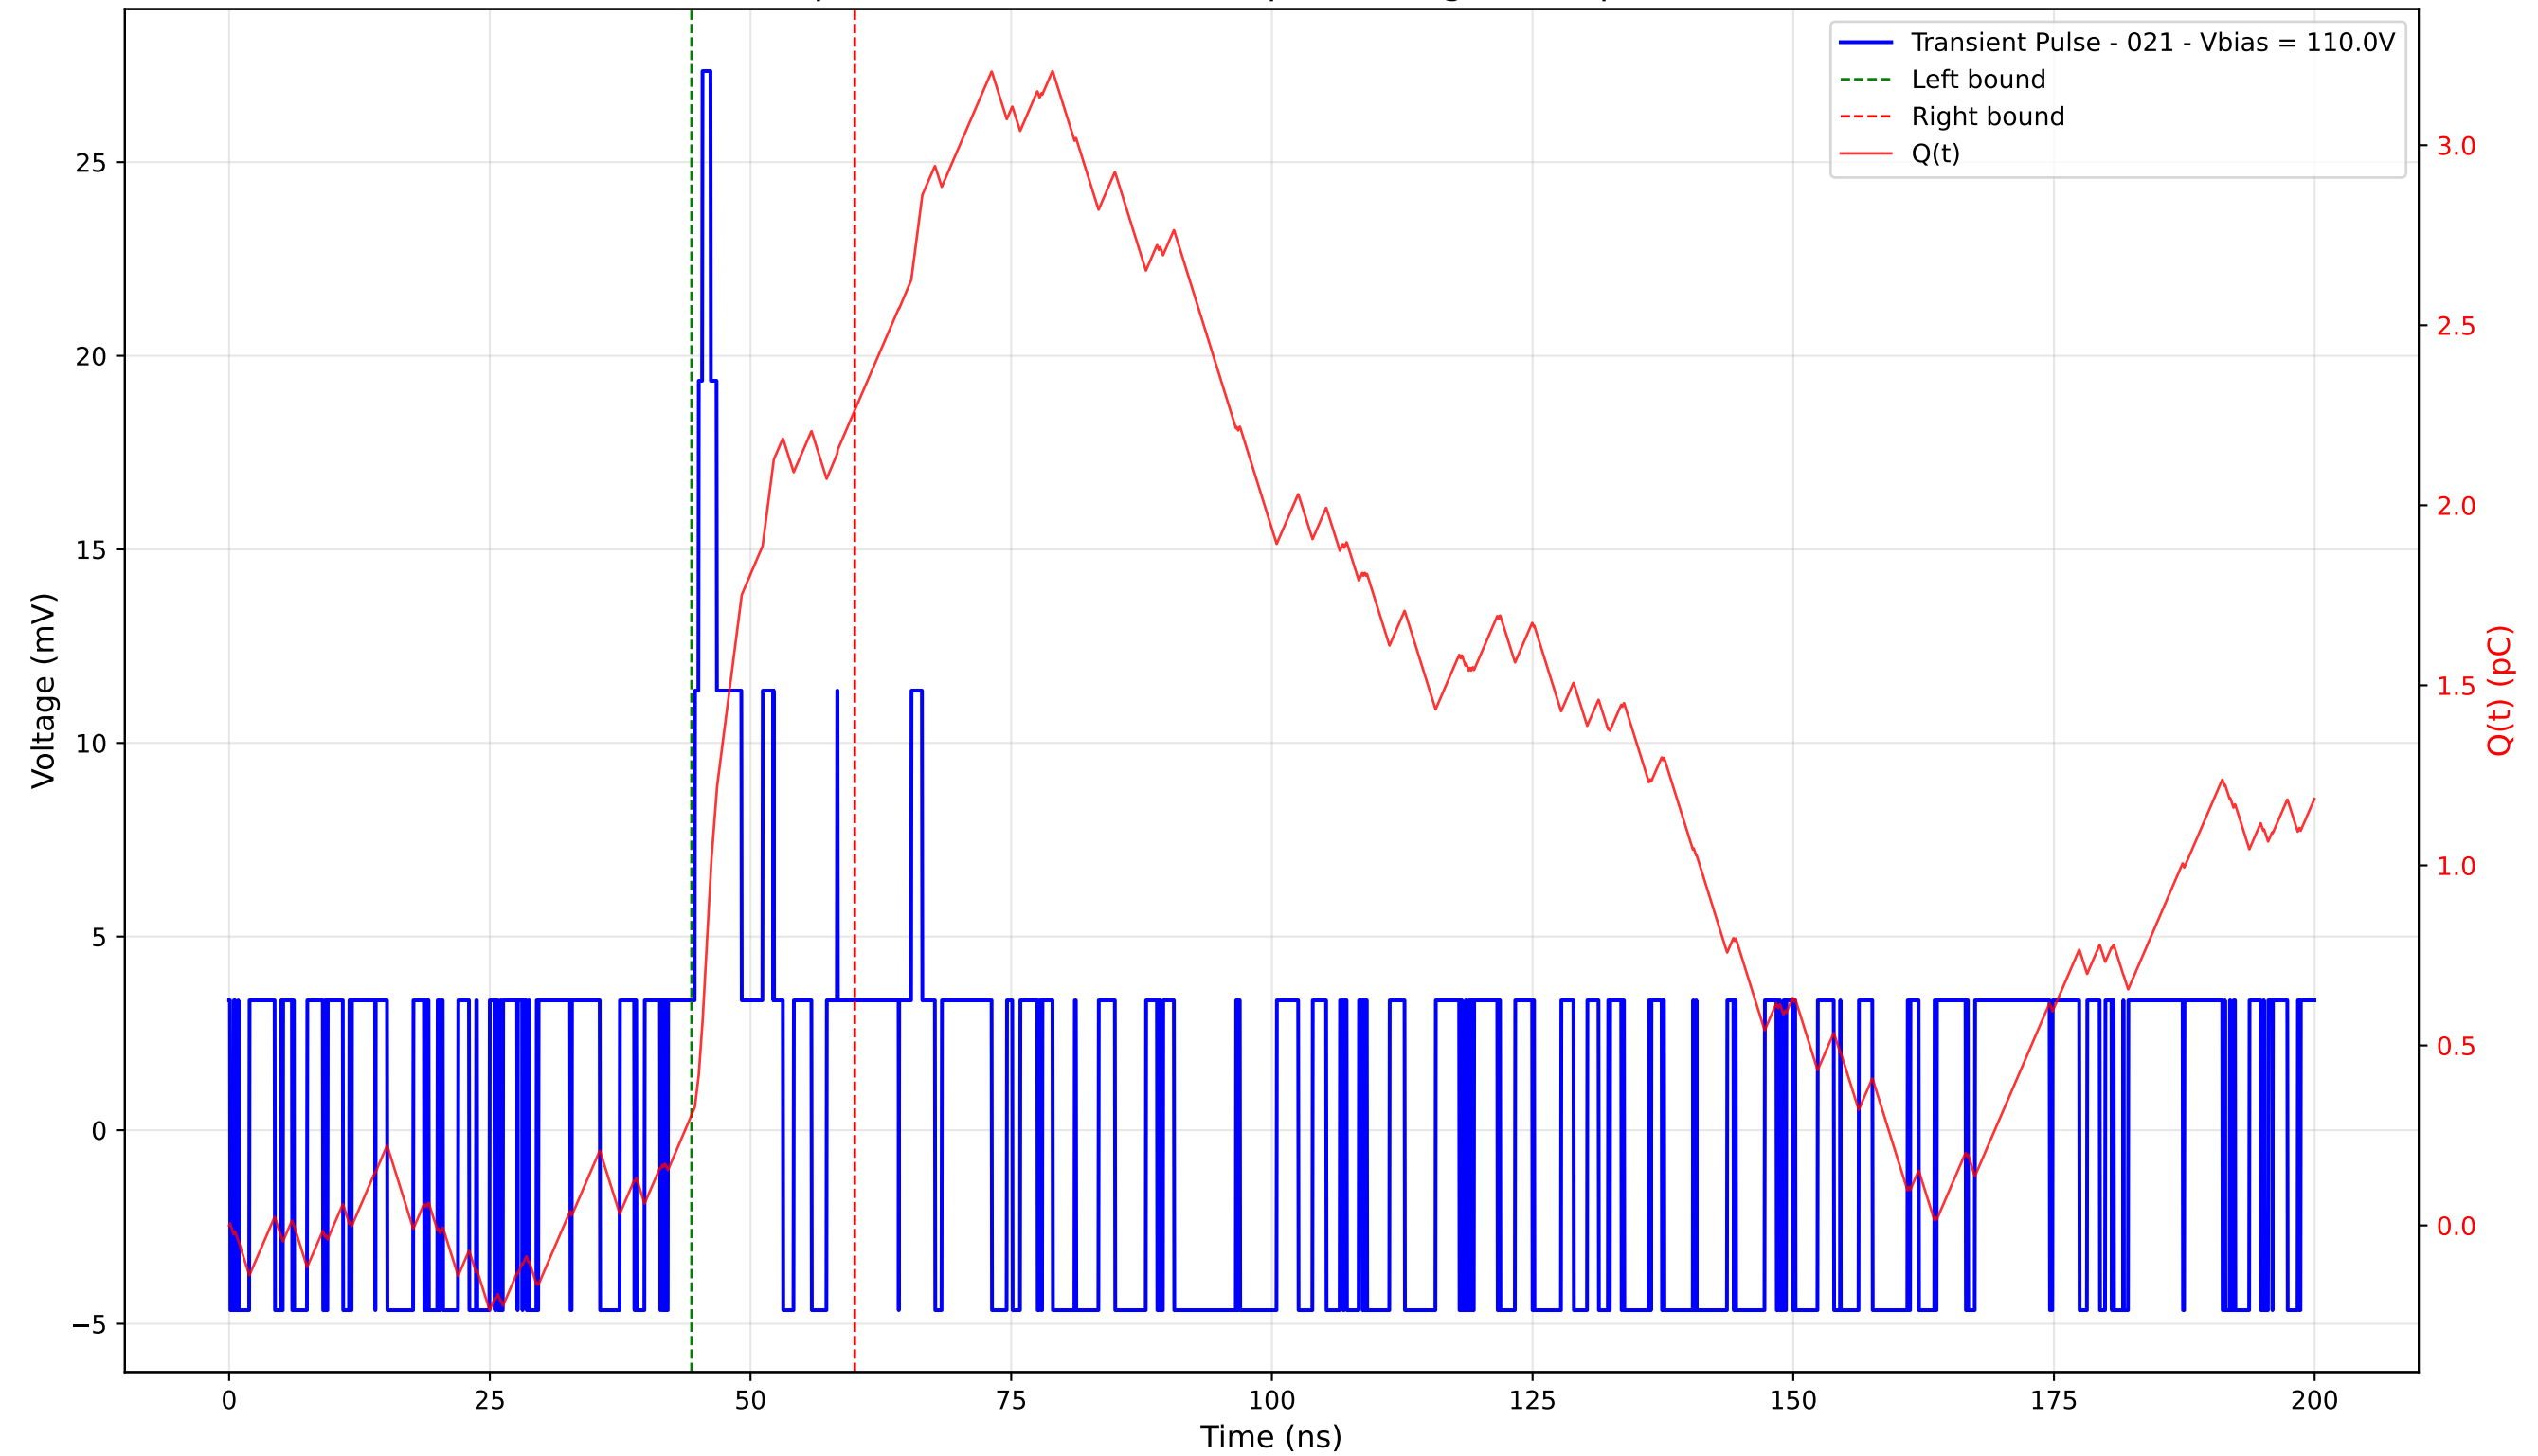


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 3.79 pC - Rise Time: 1.17 ns

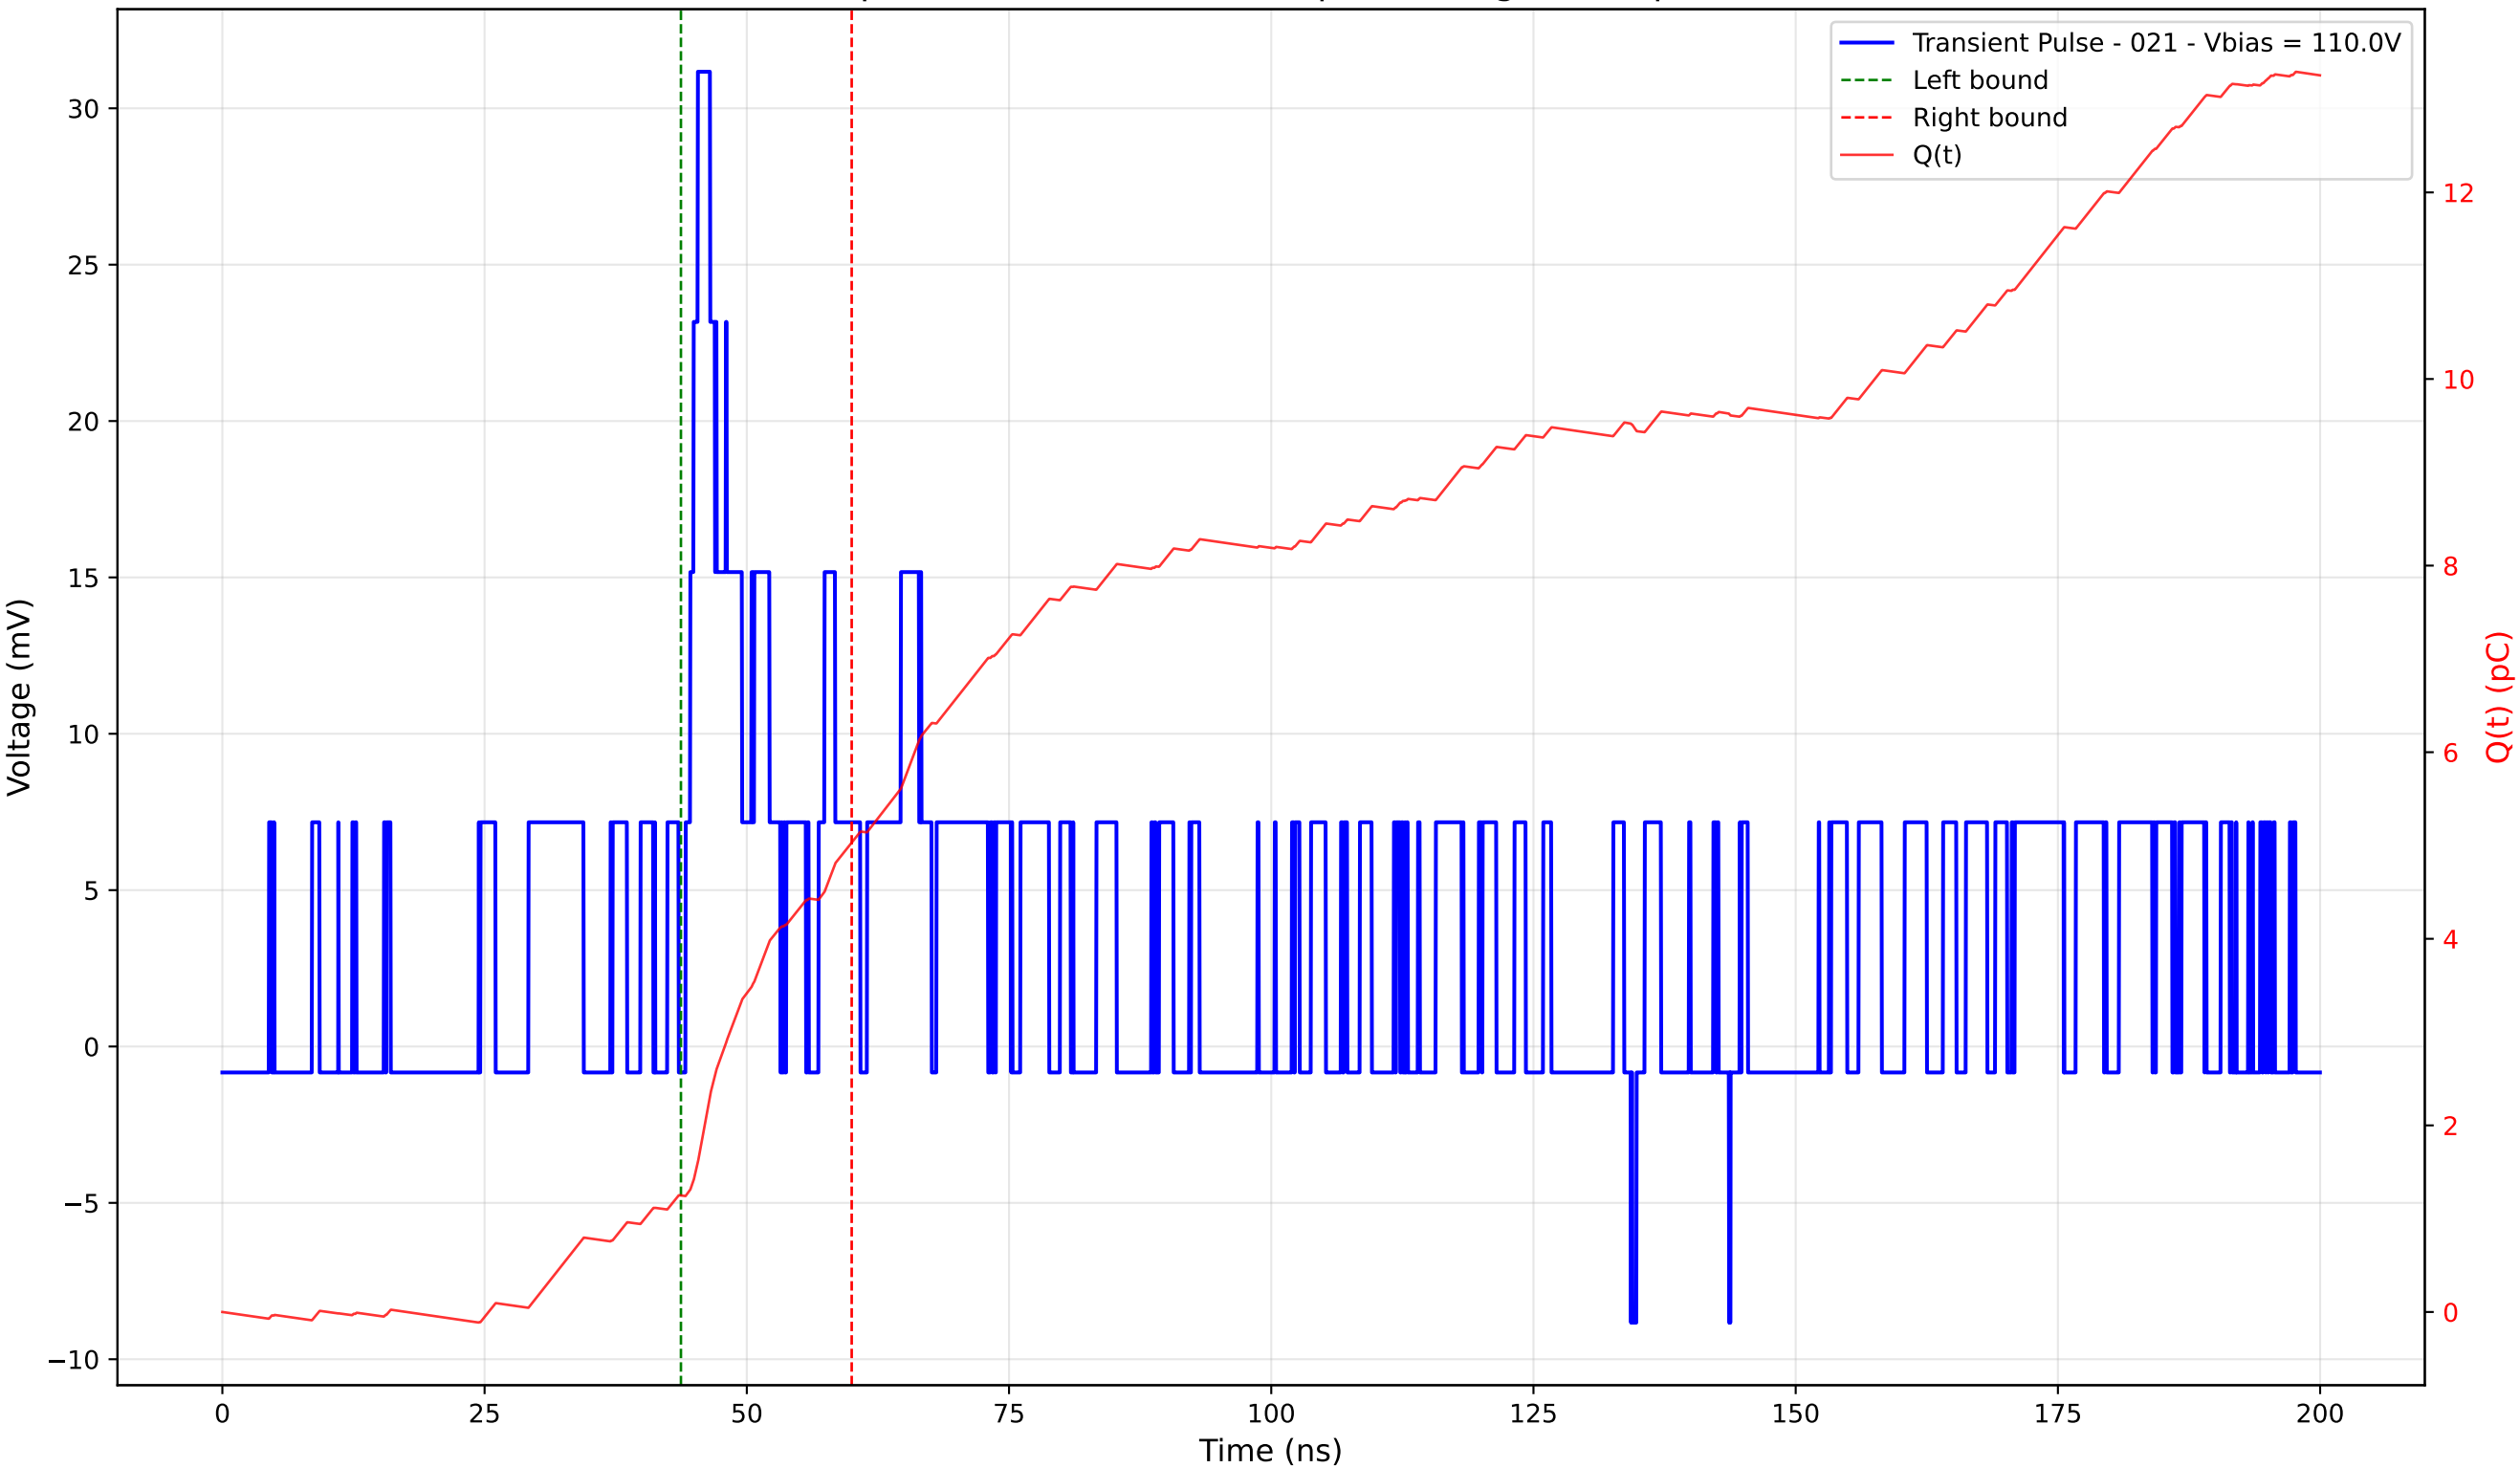


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.32 pC - Rise Time: 0.92 ns

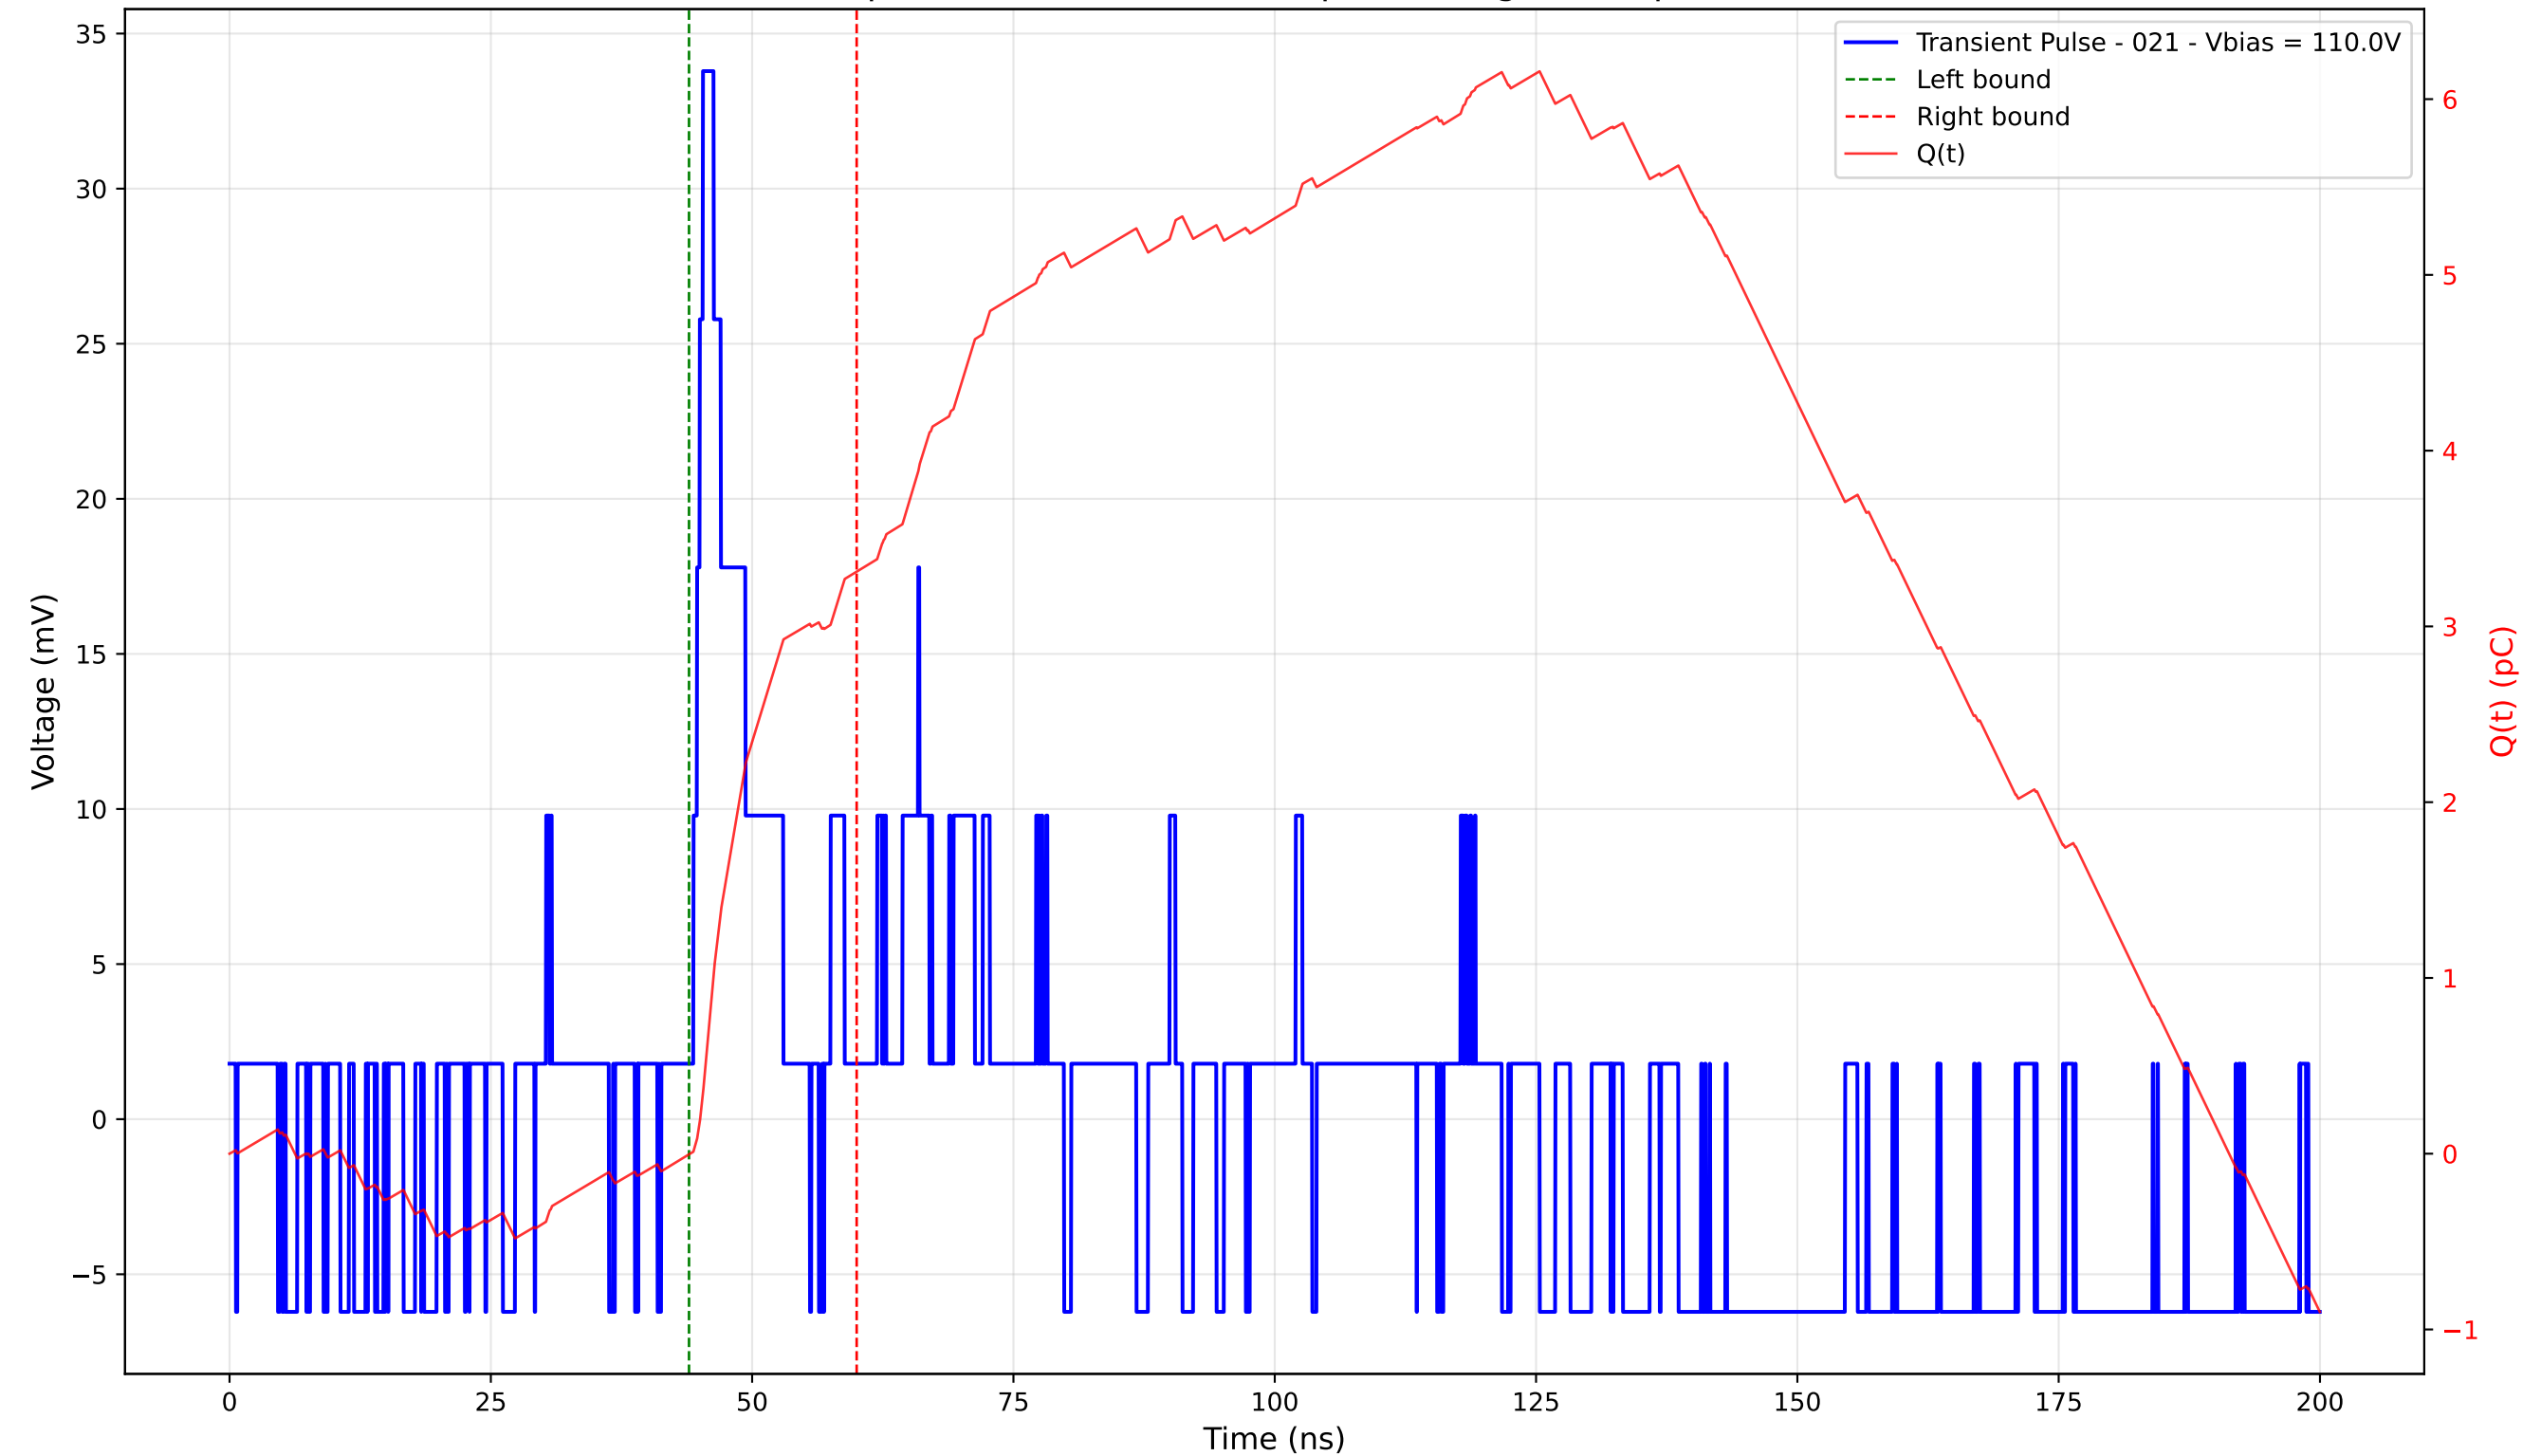


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.92 pC - Rise Time: 1.35 ns

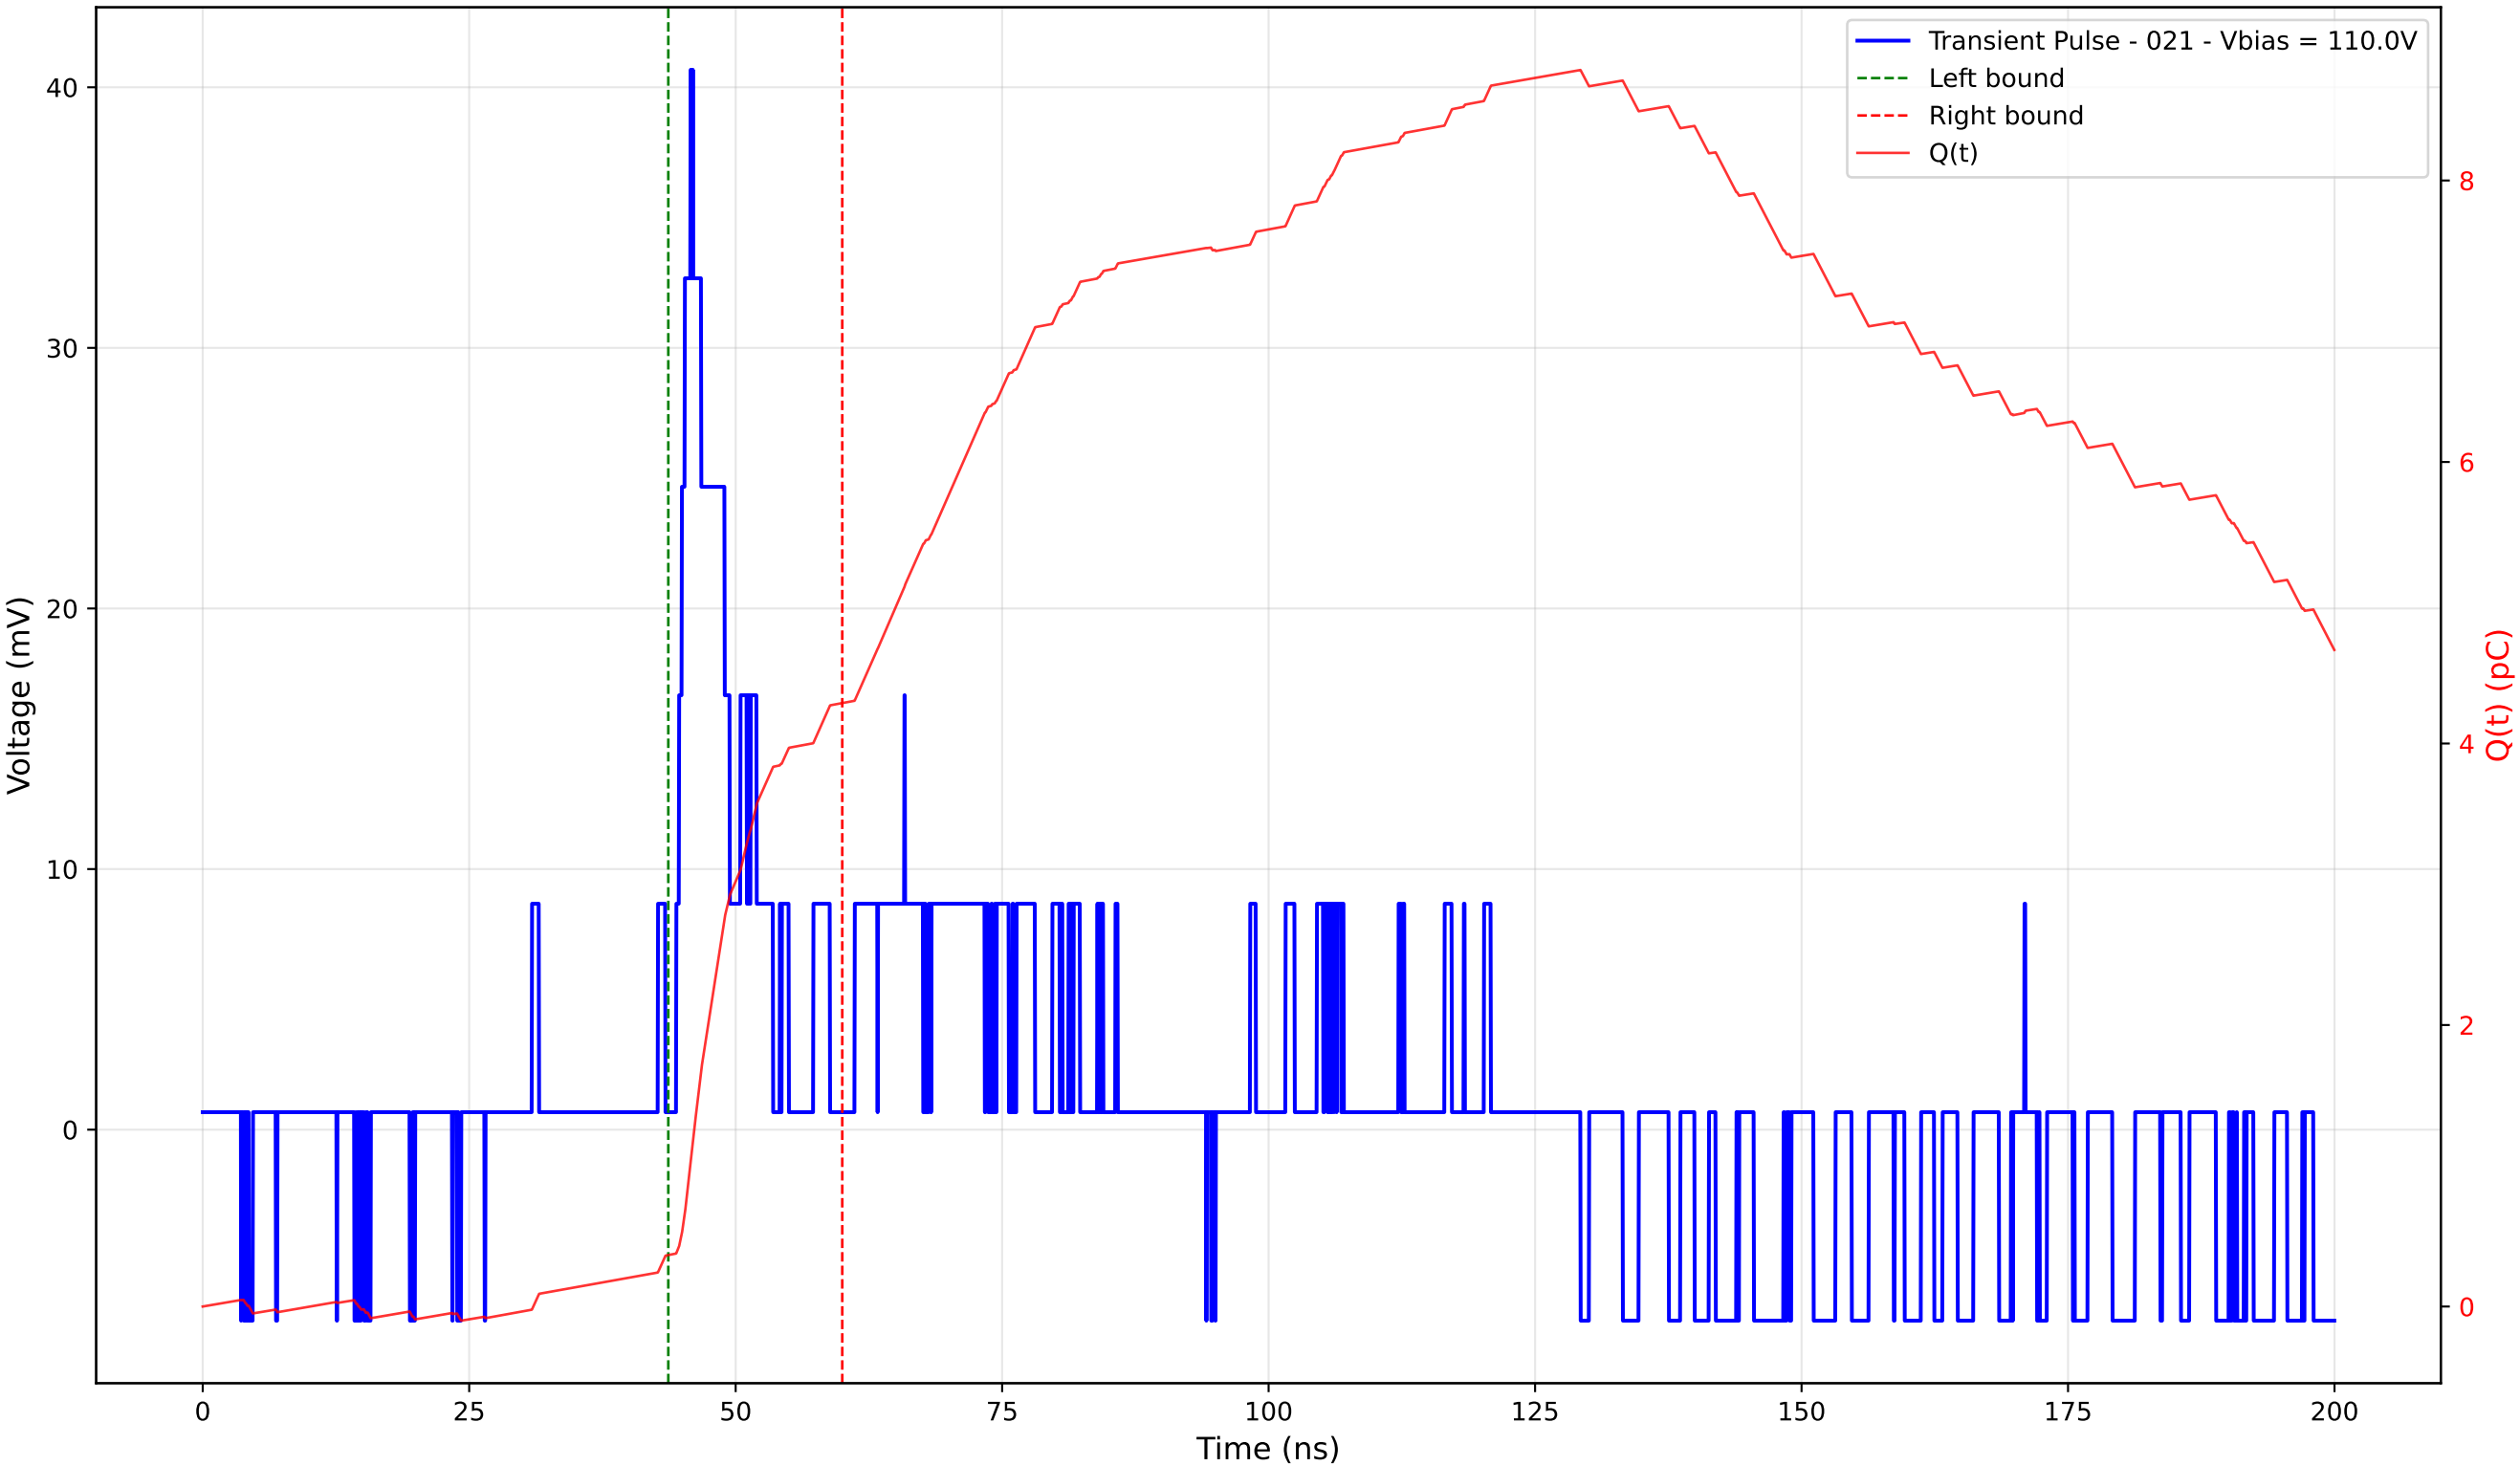


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 4.10 pC - Rise Time: 1.24 ns

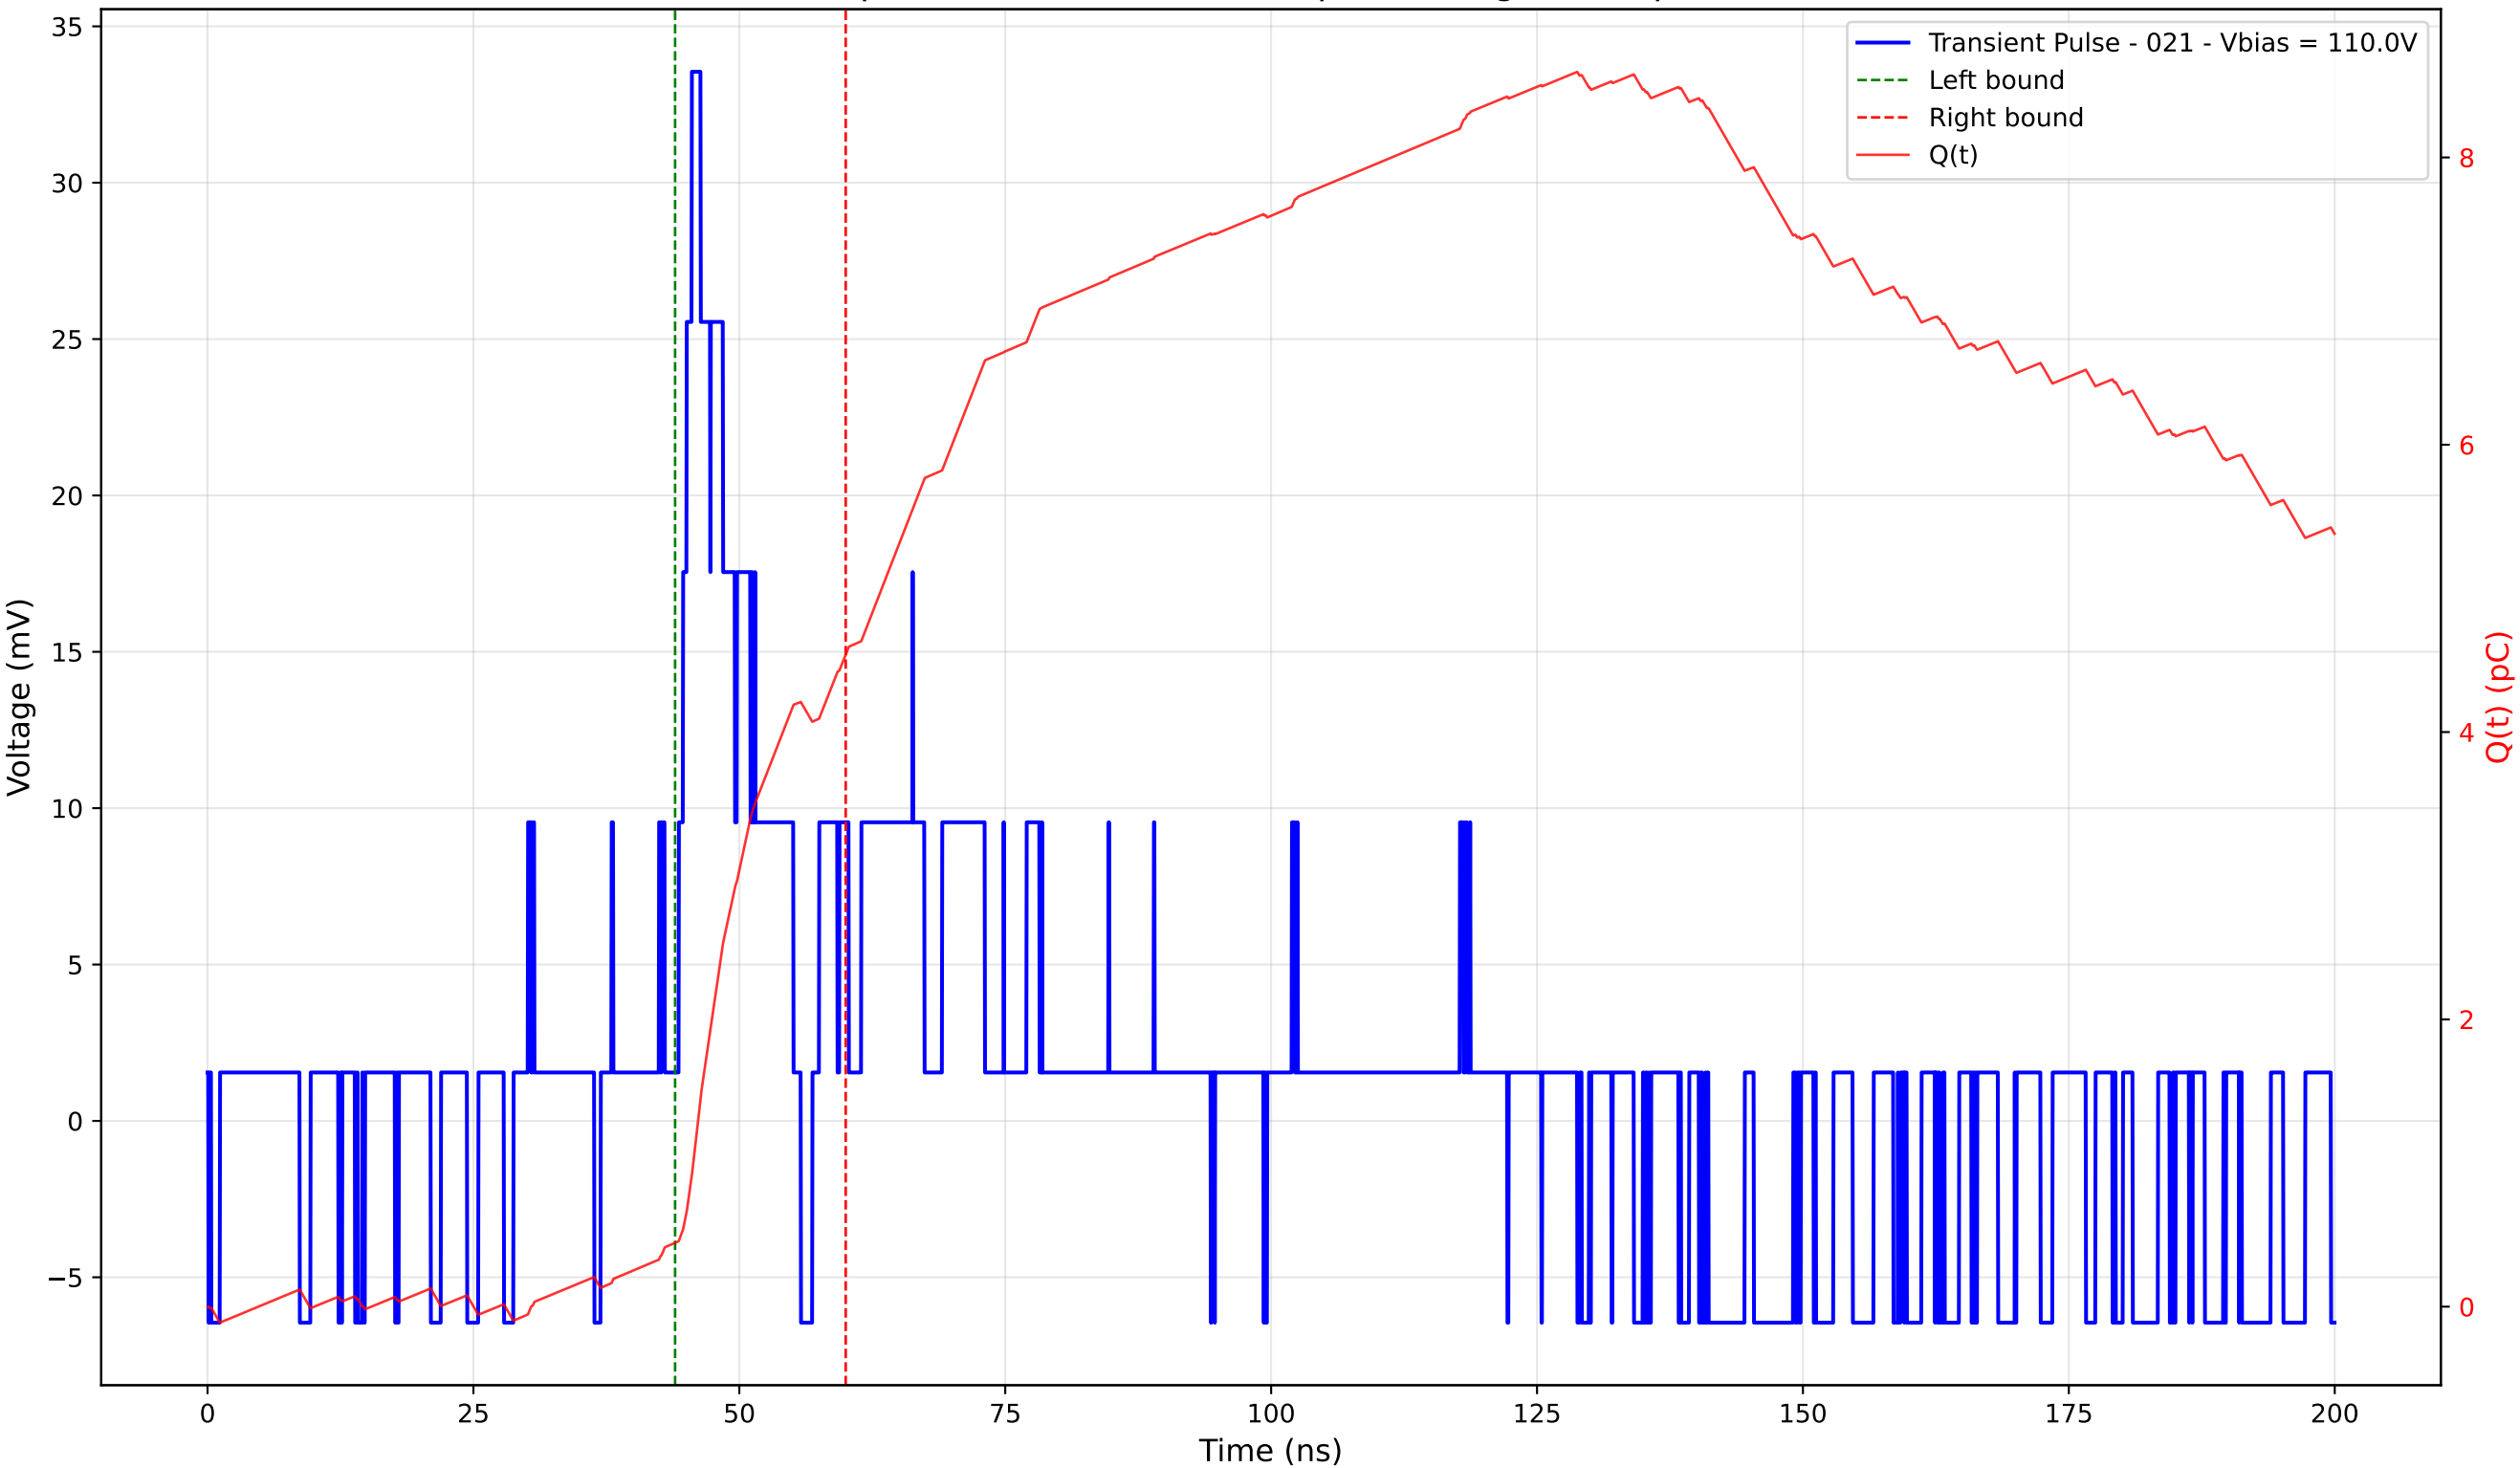


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 3.78 pC - Rise Time: 0.76 ns

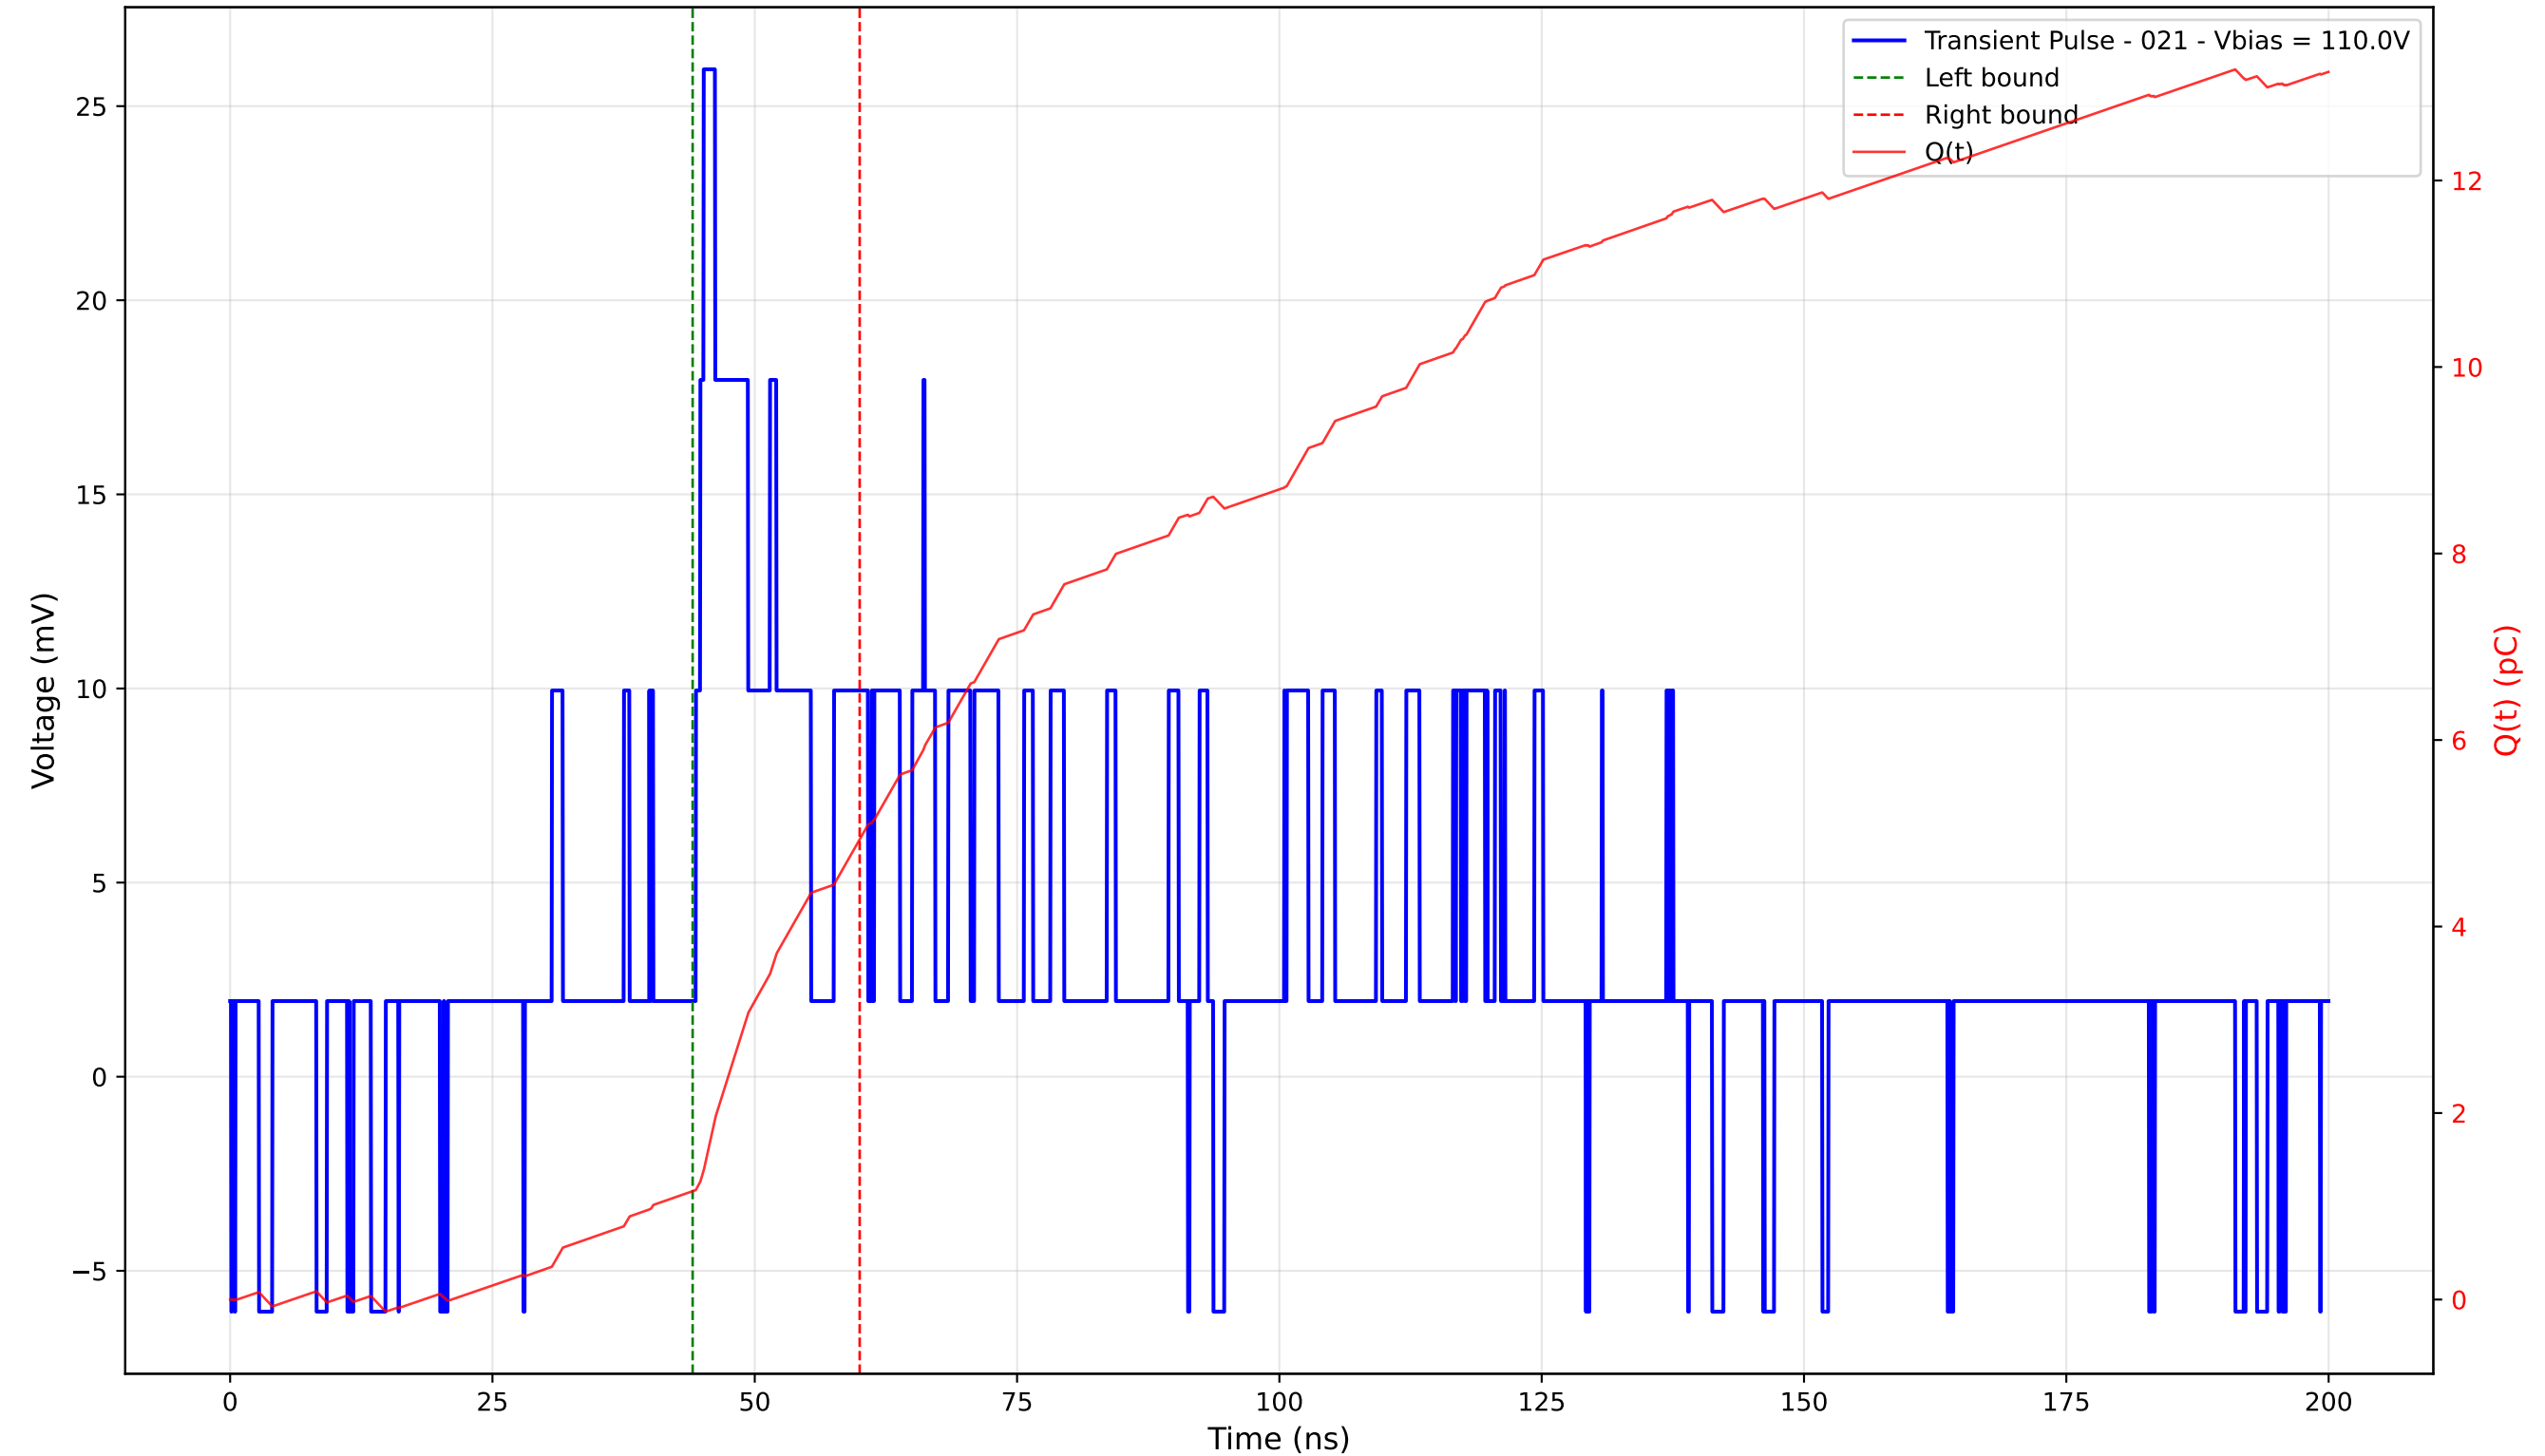


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 1.89 pC - Rise Time: 0.66 ns

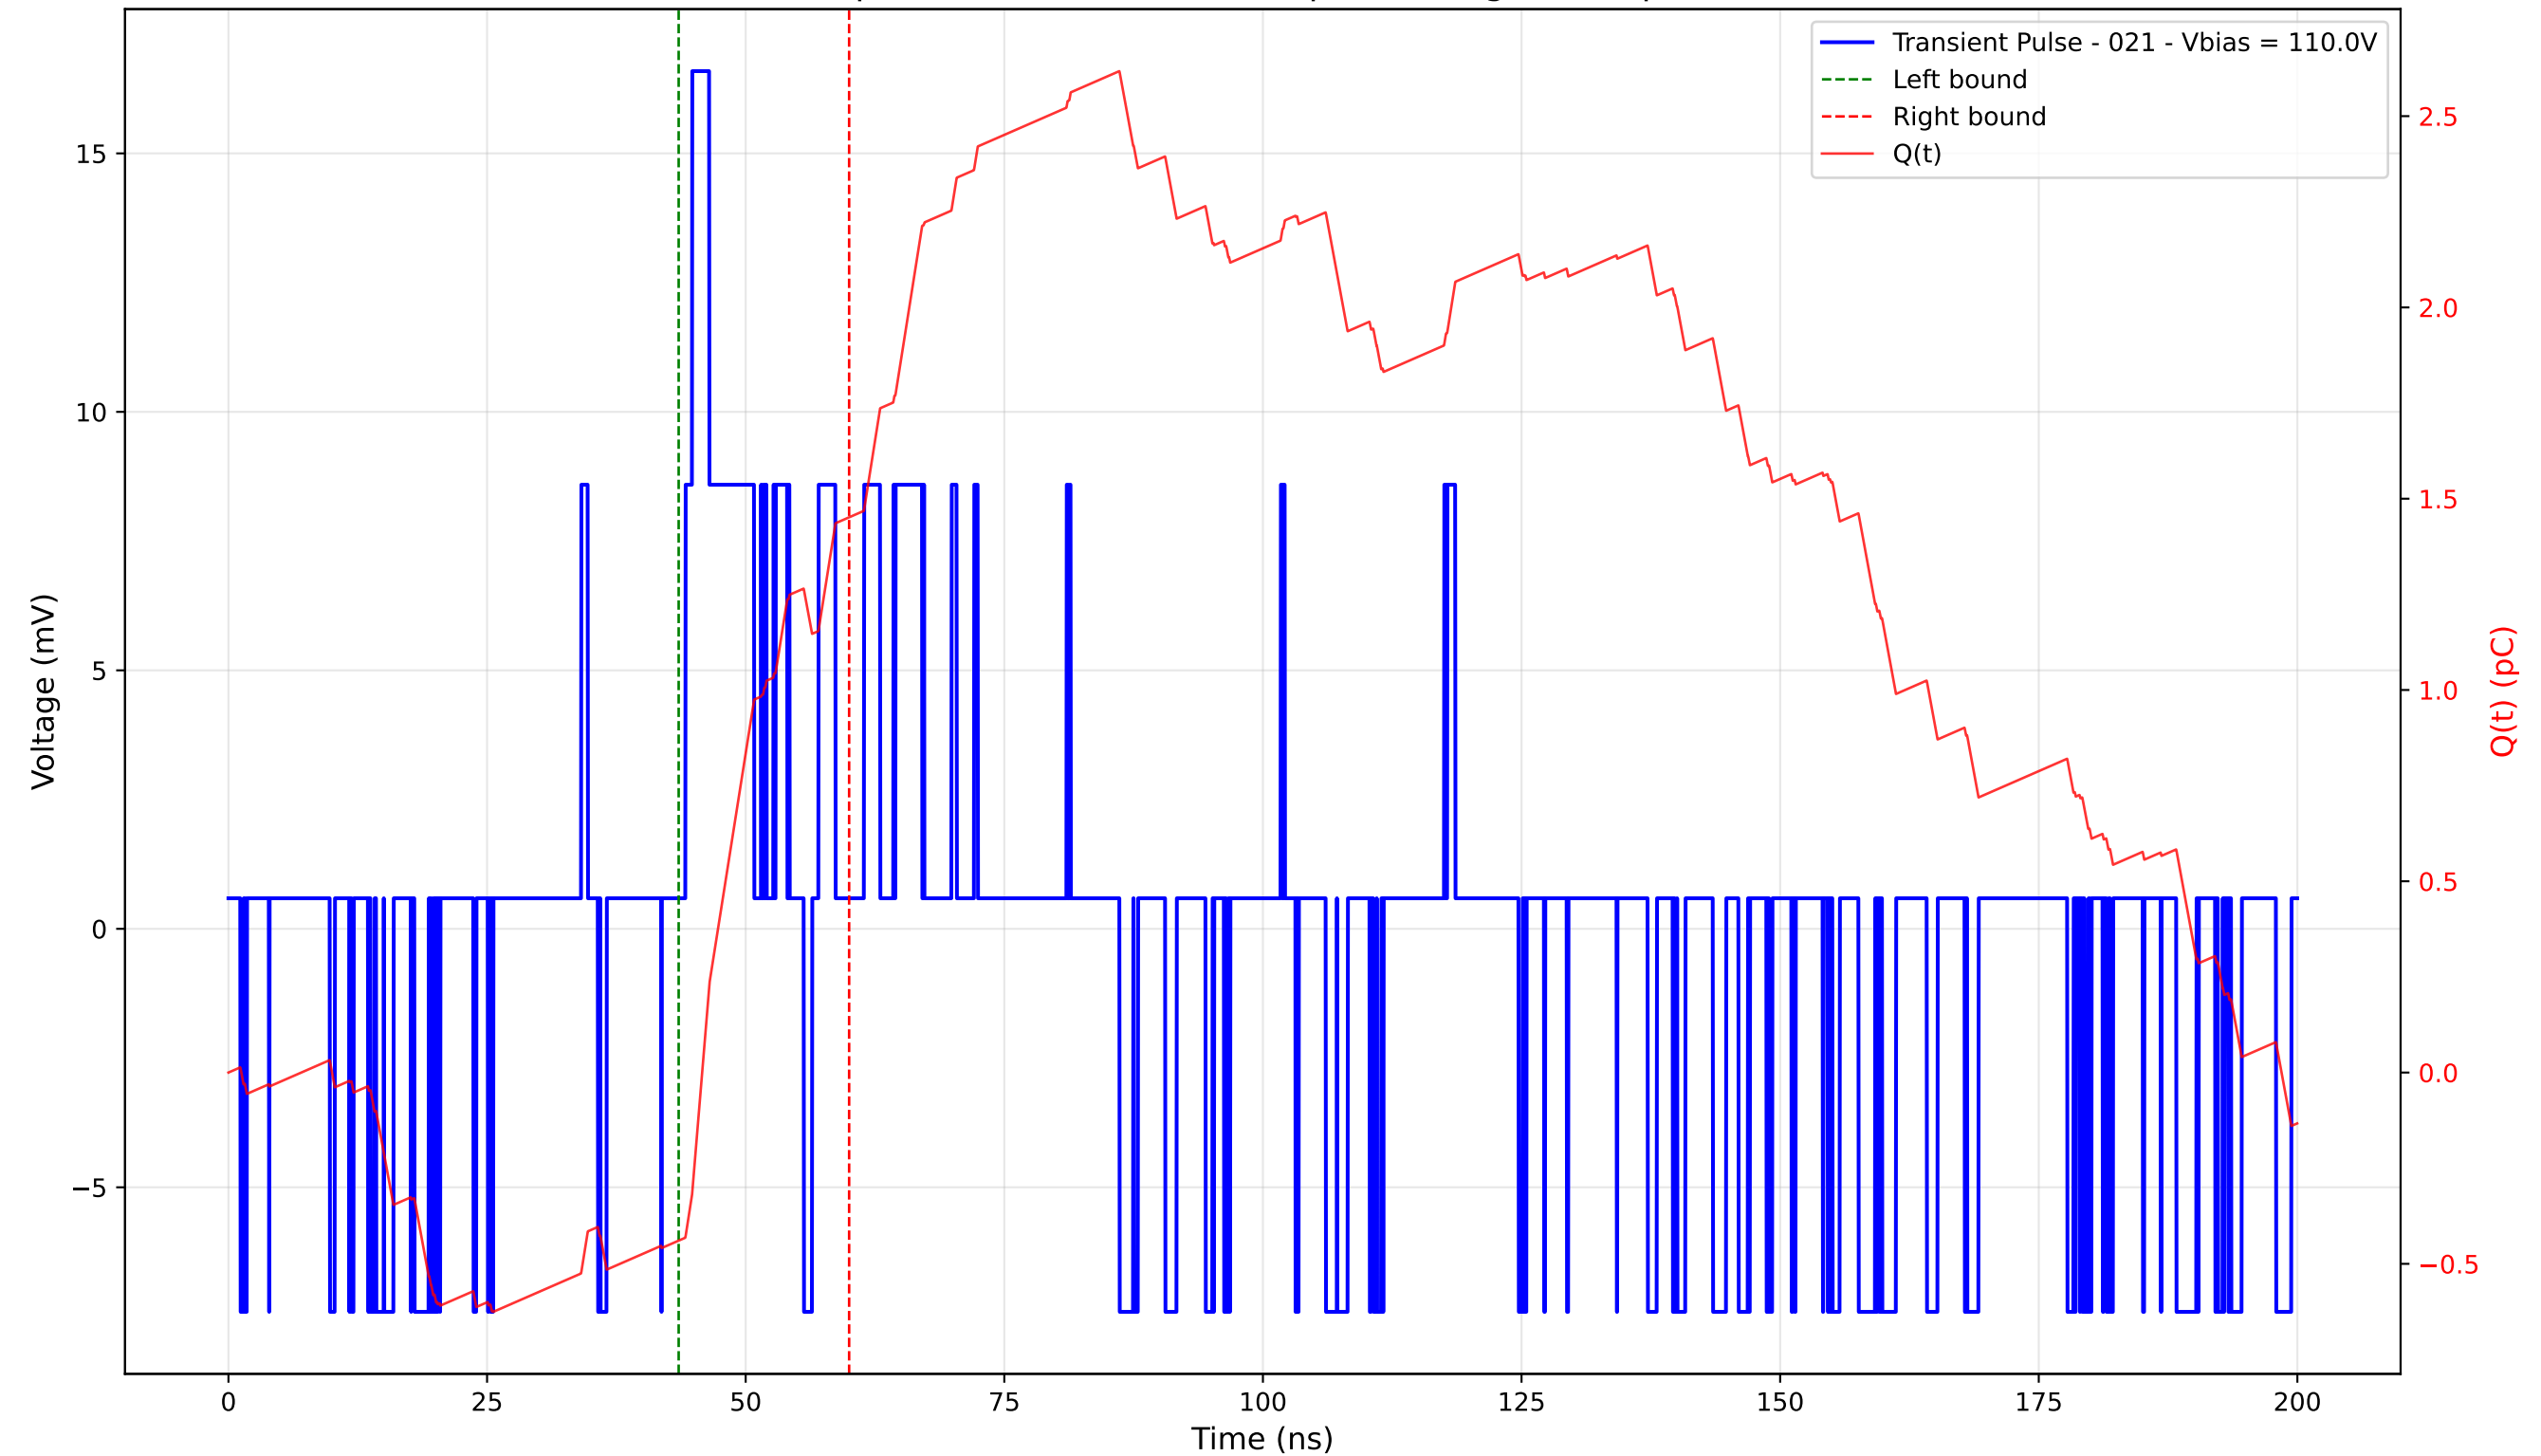


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 2.82 pC - Rise Time: 0.00 ns (N/A)

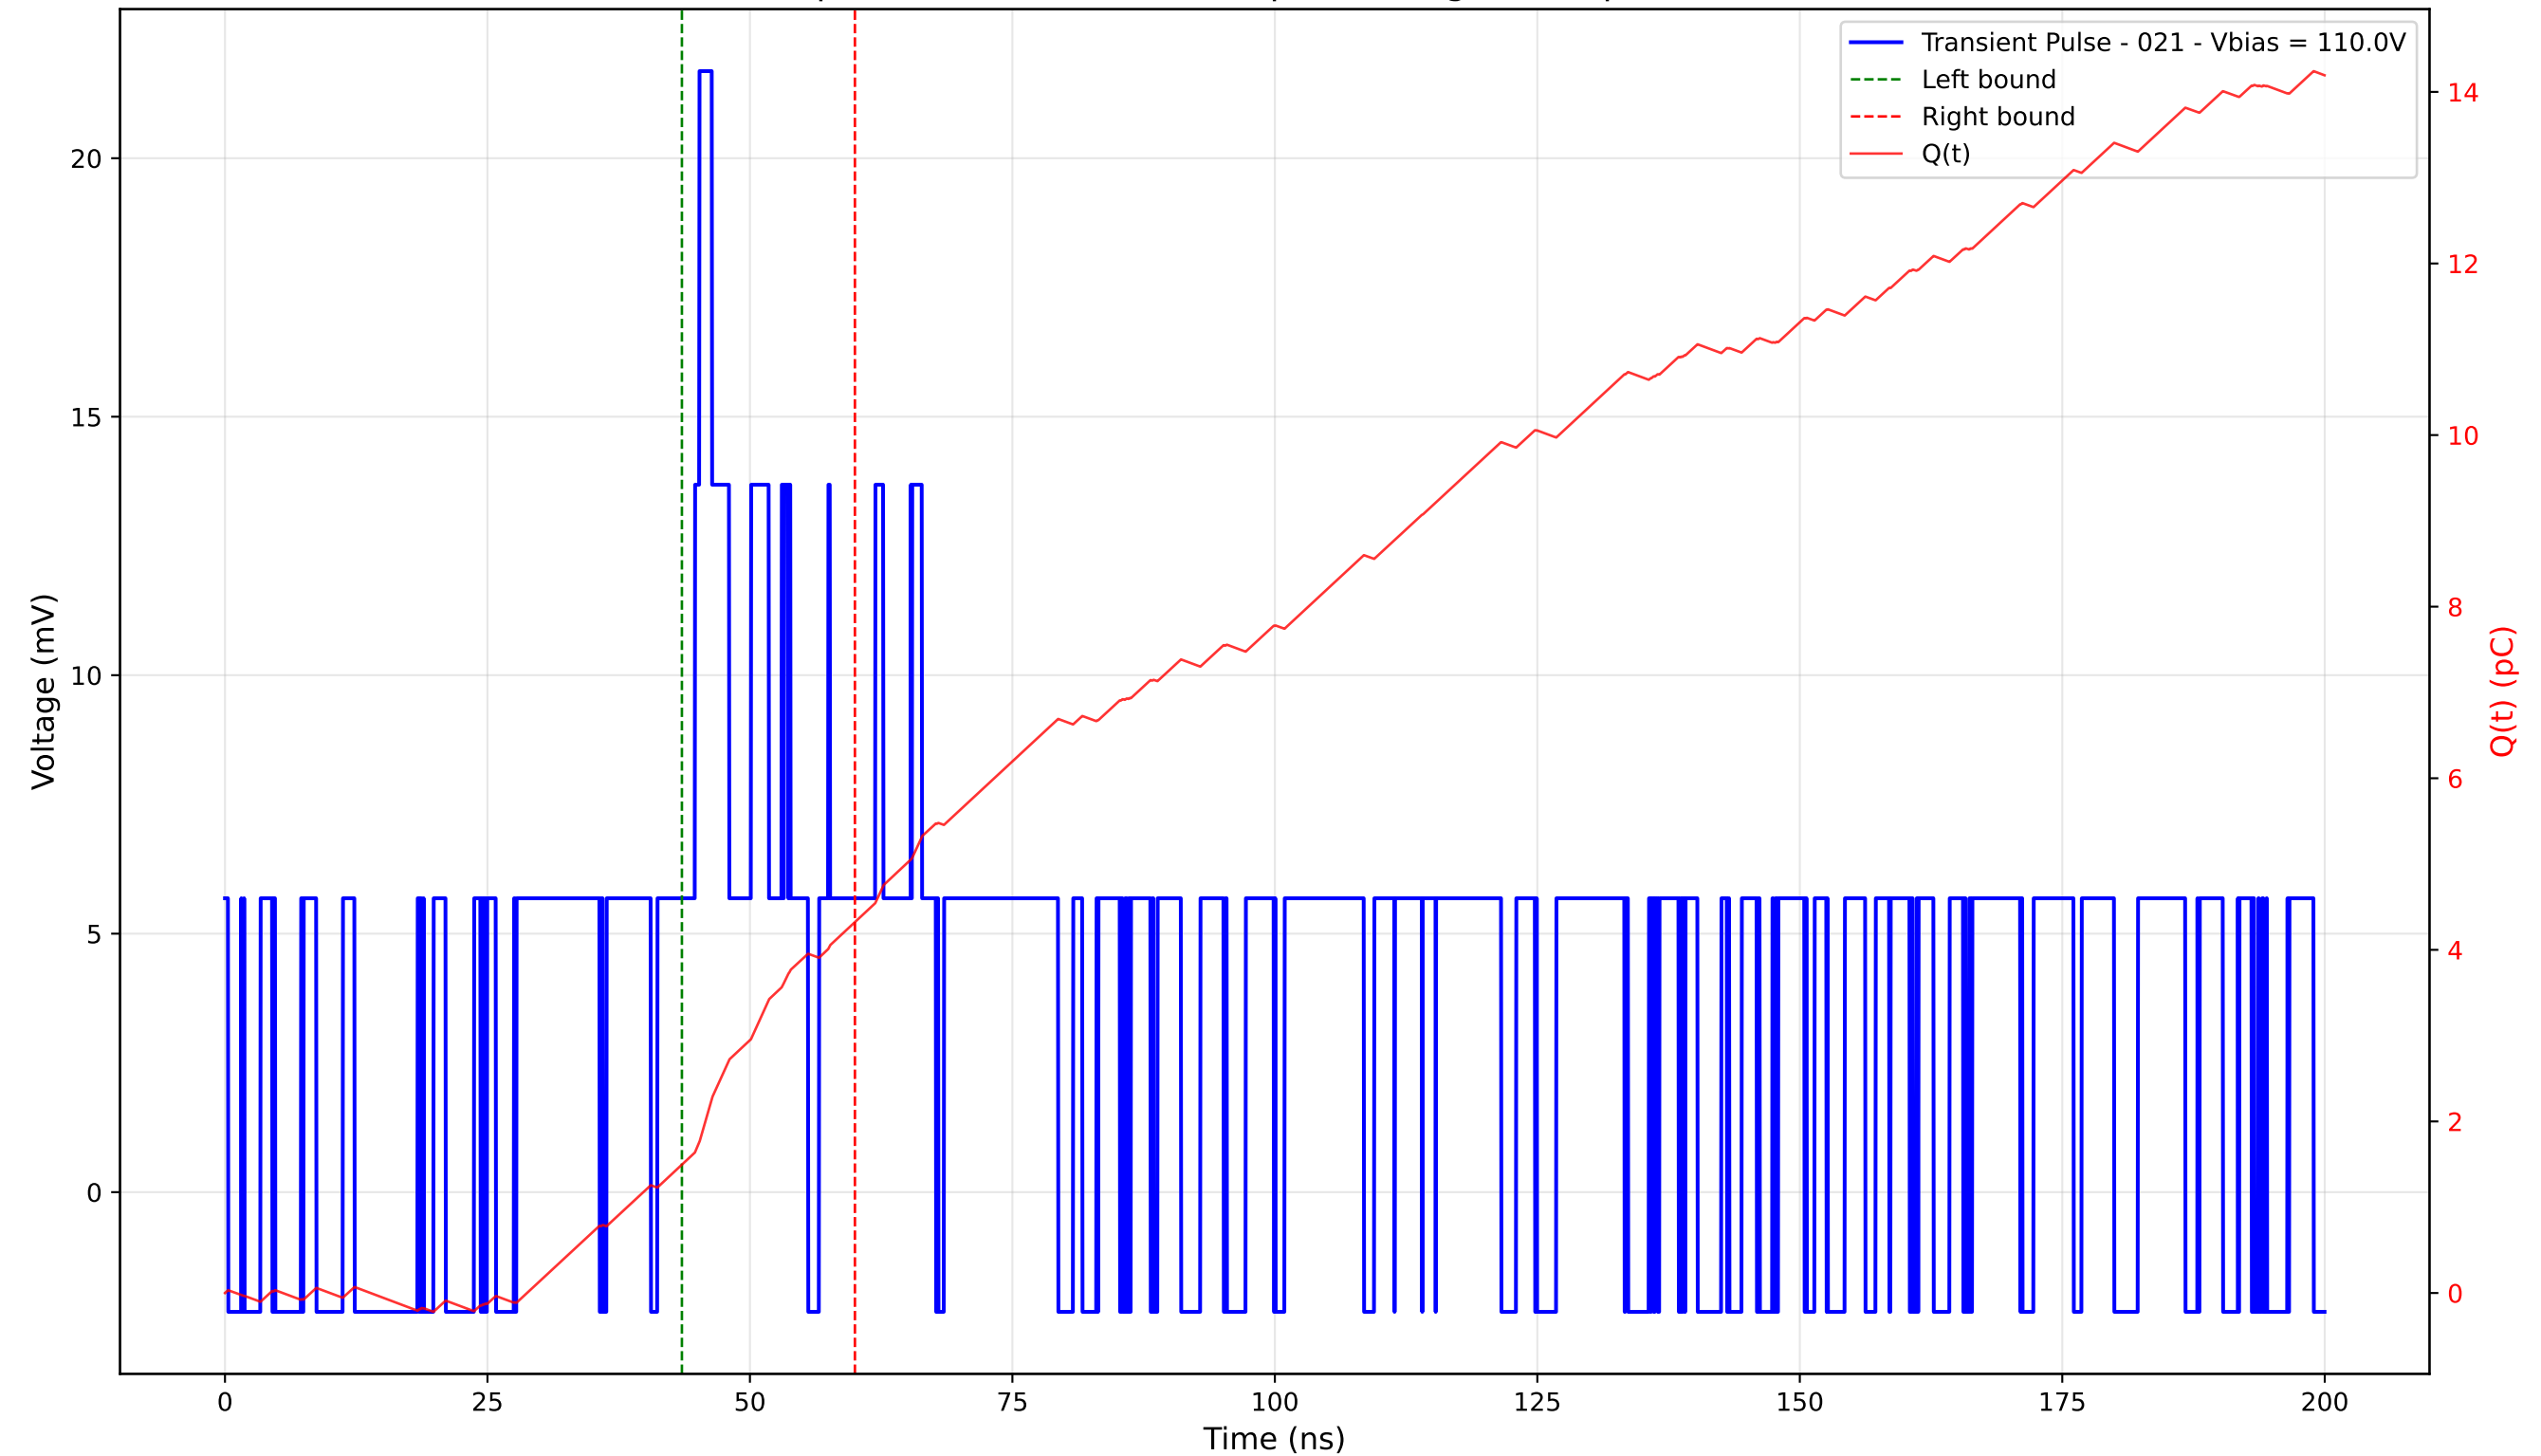


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.76 pC - Rise Time: 0.00 ns (N/A)

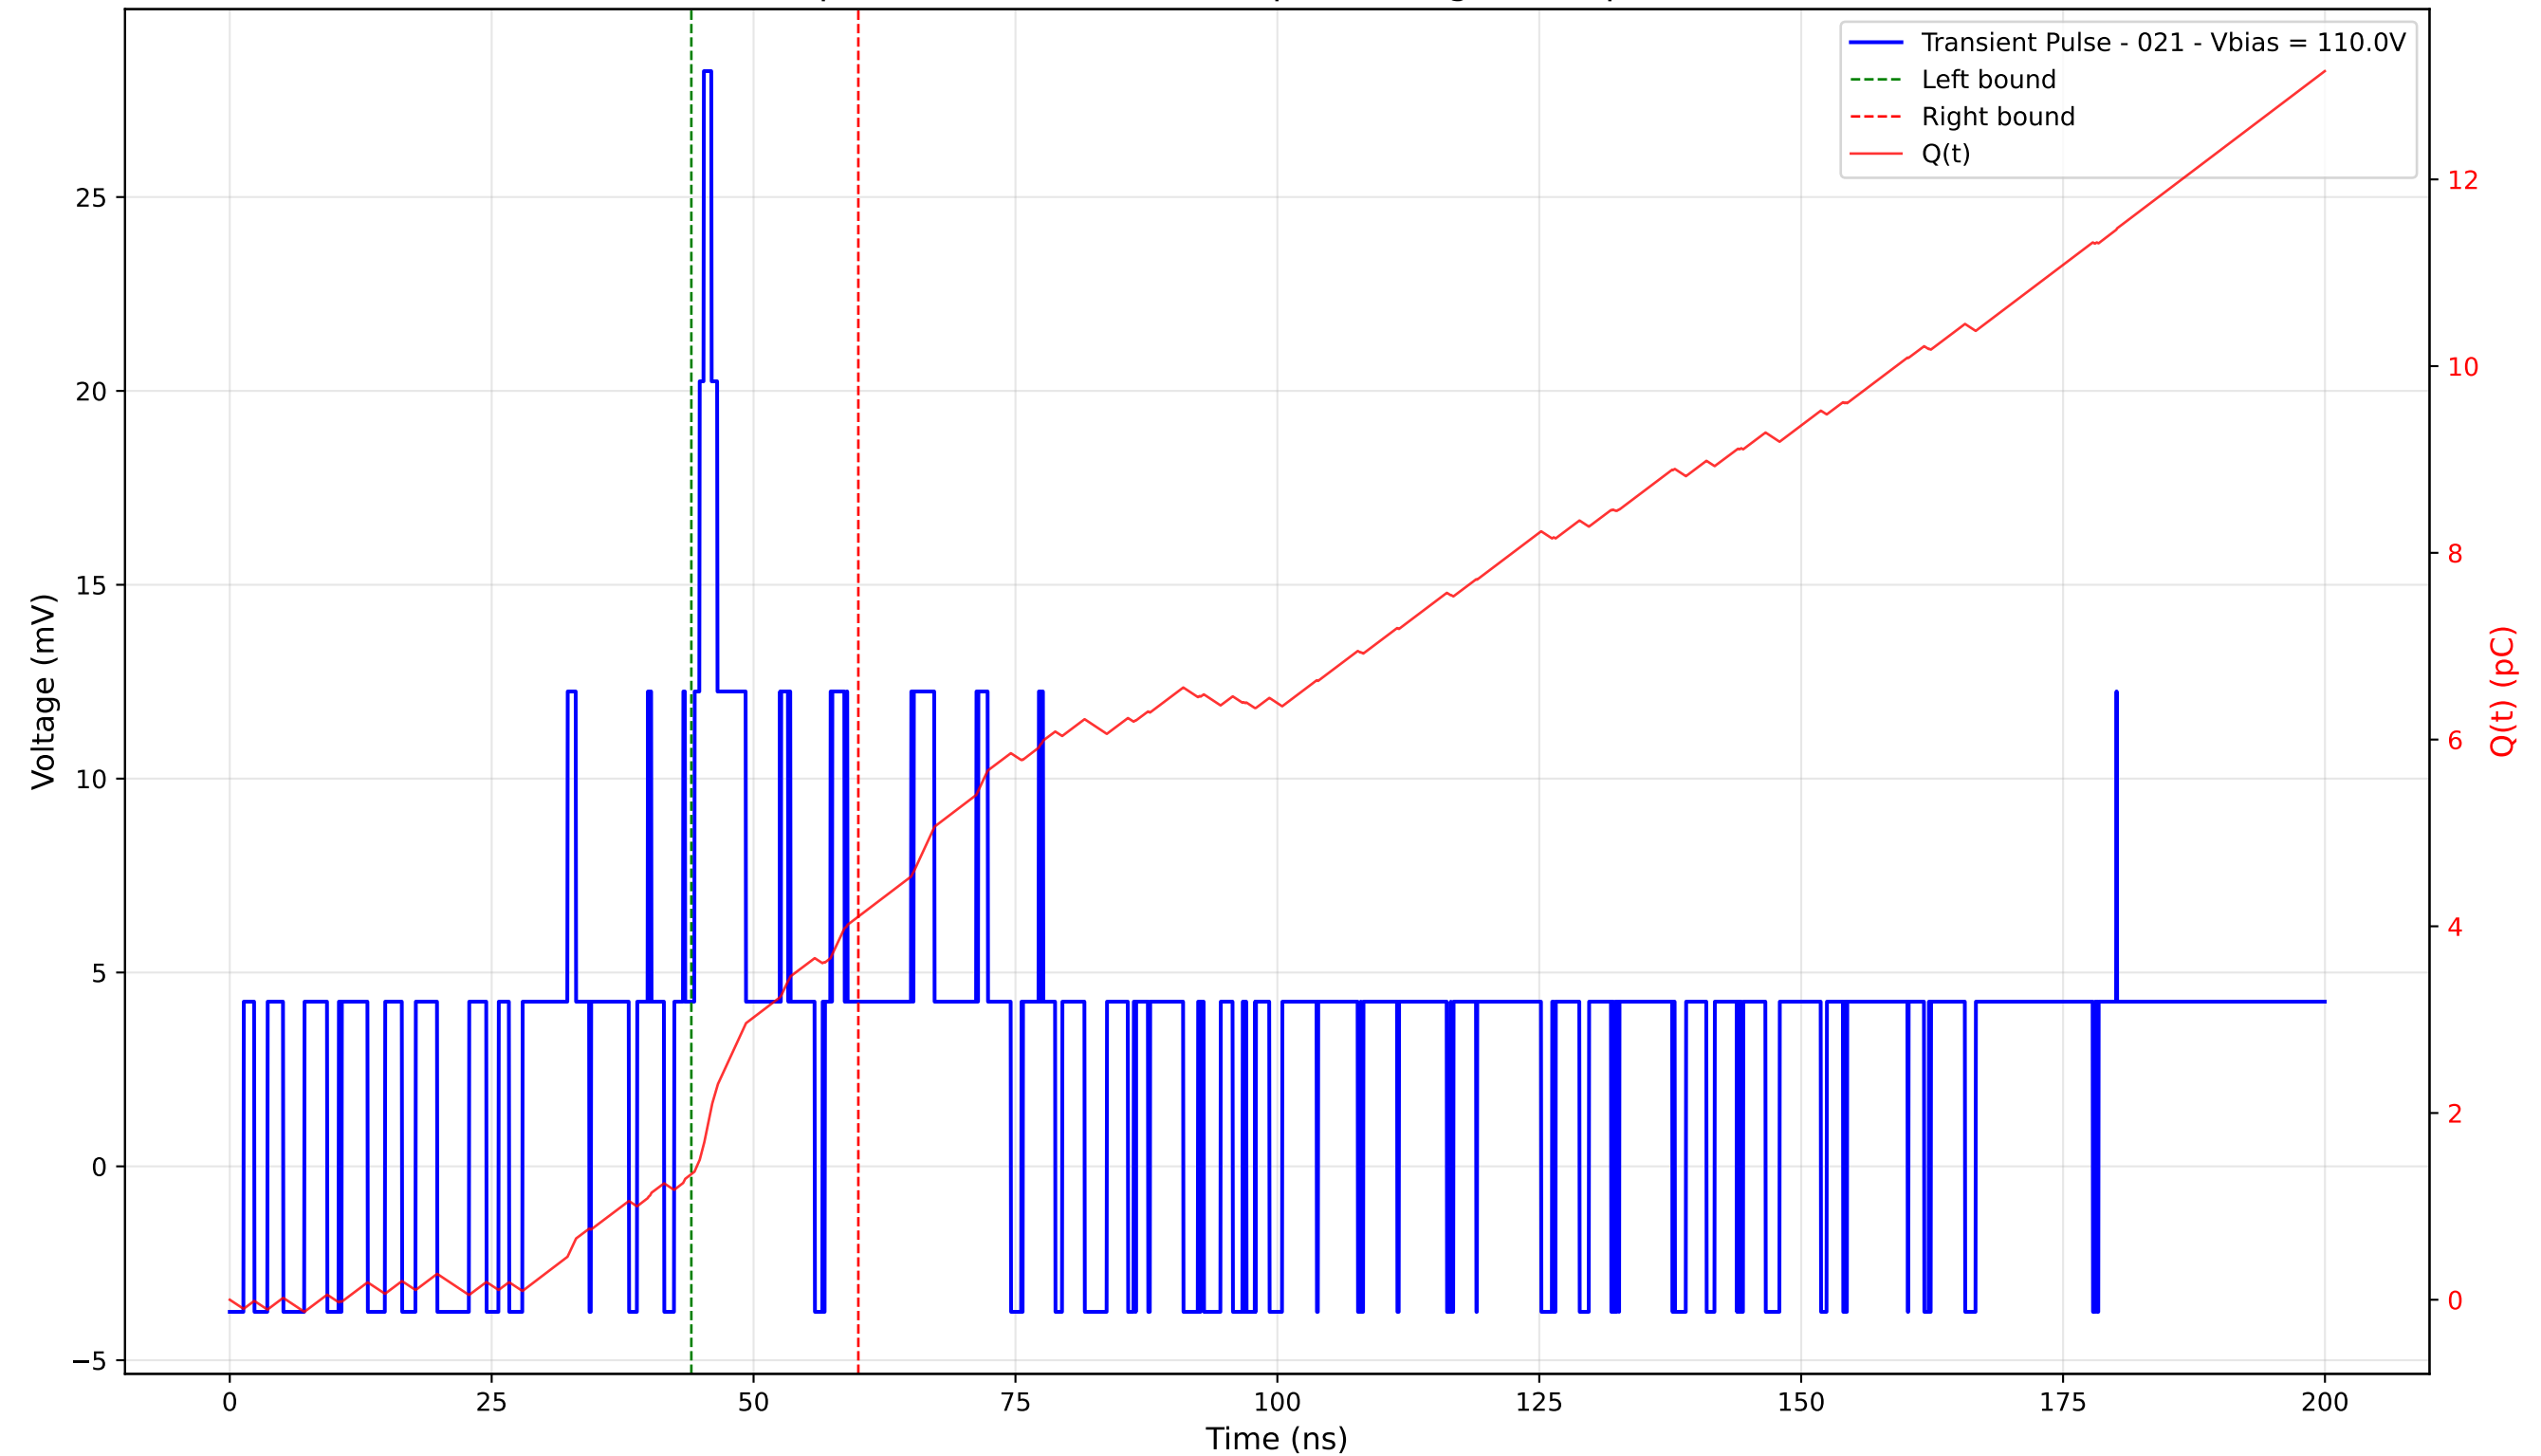


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 2.27 pC - Rise Time: 1.21 ns

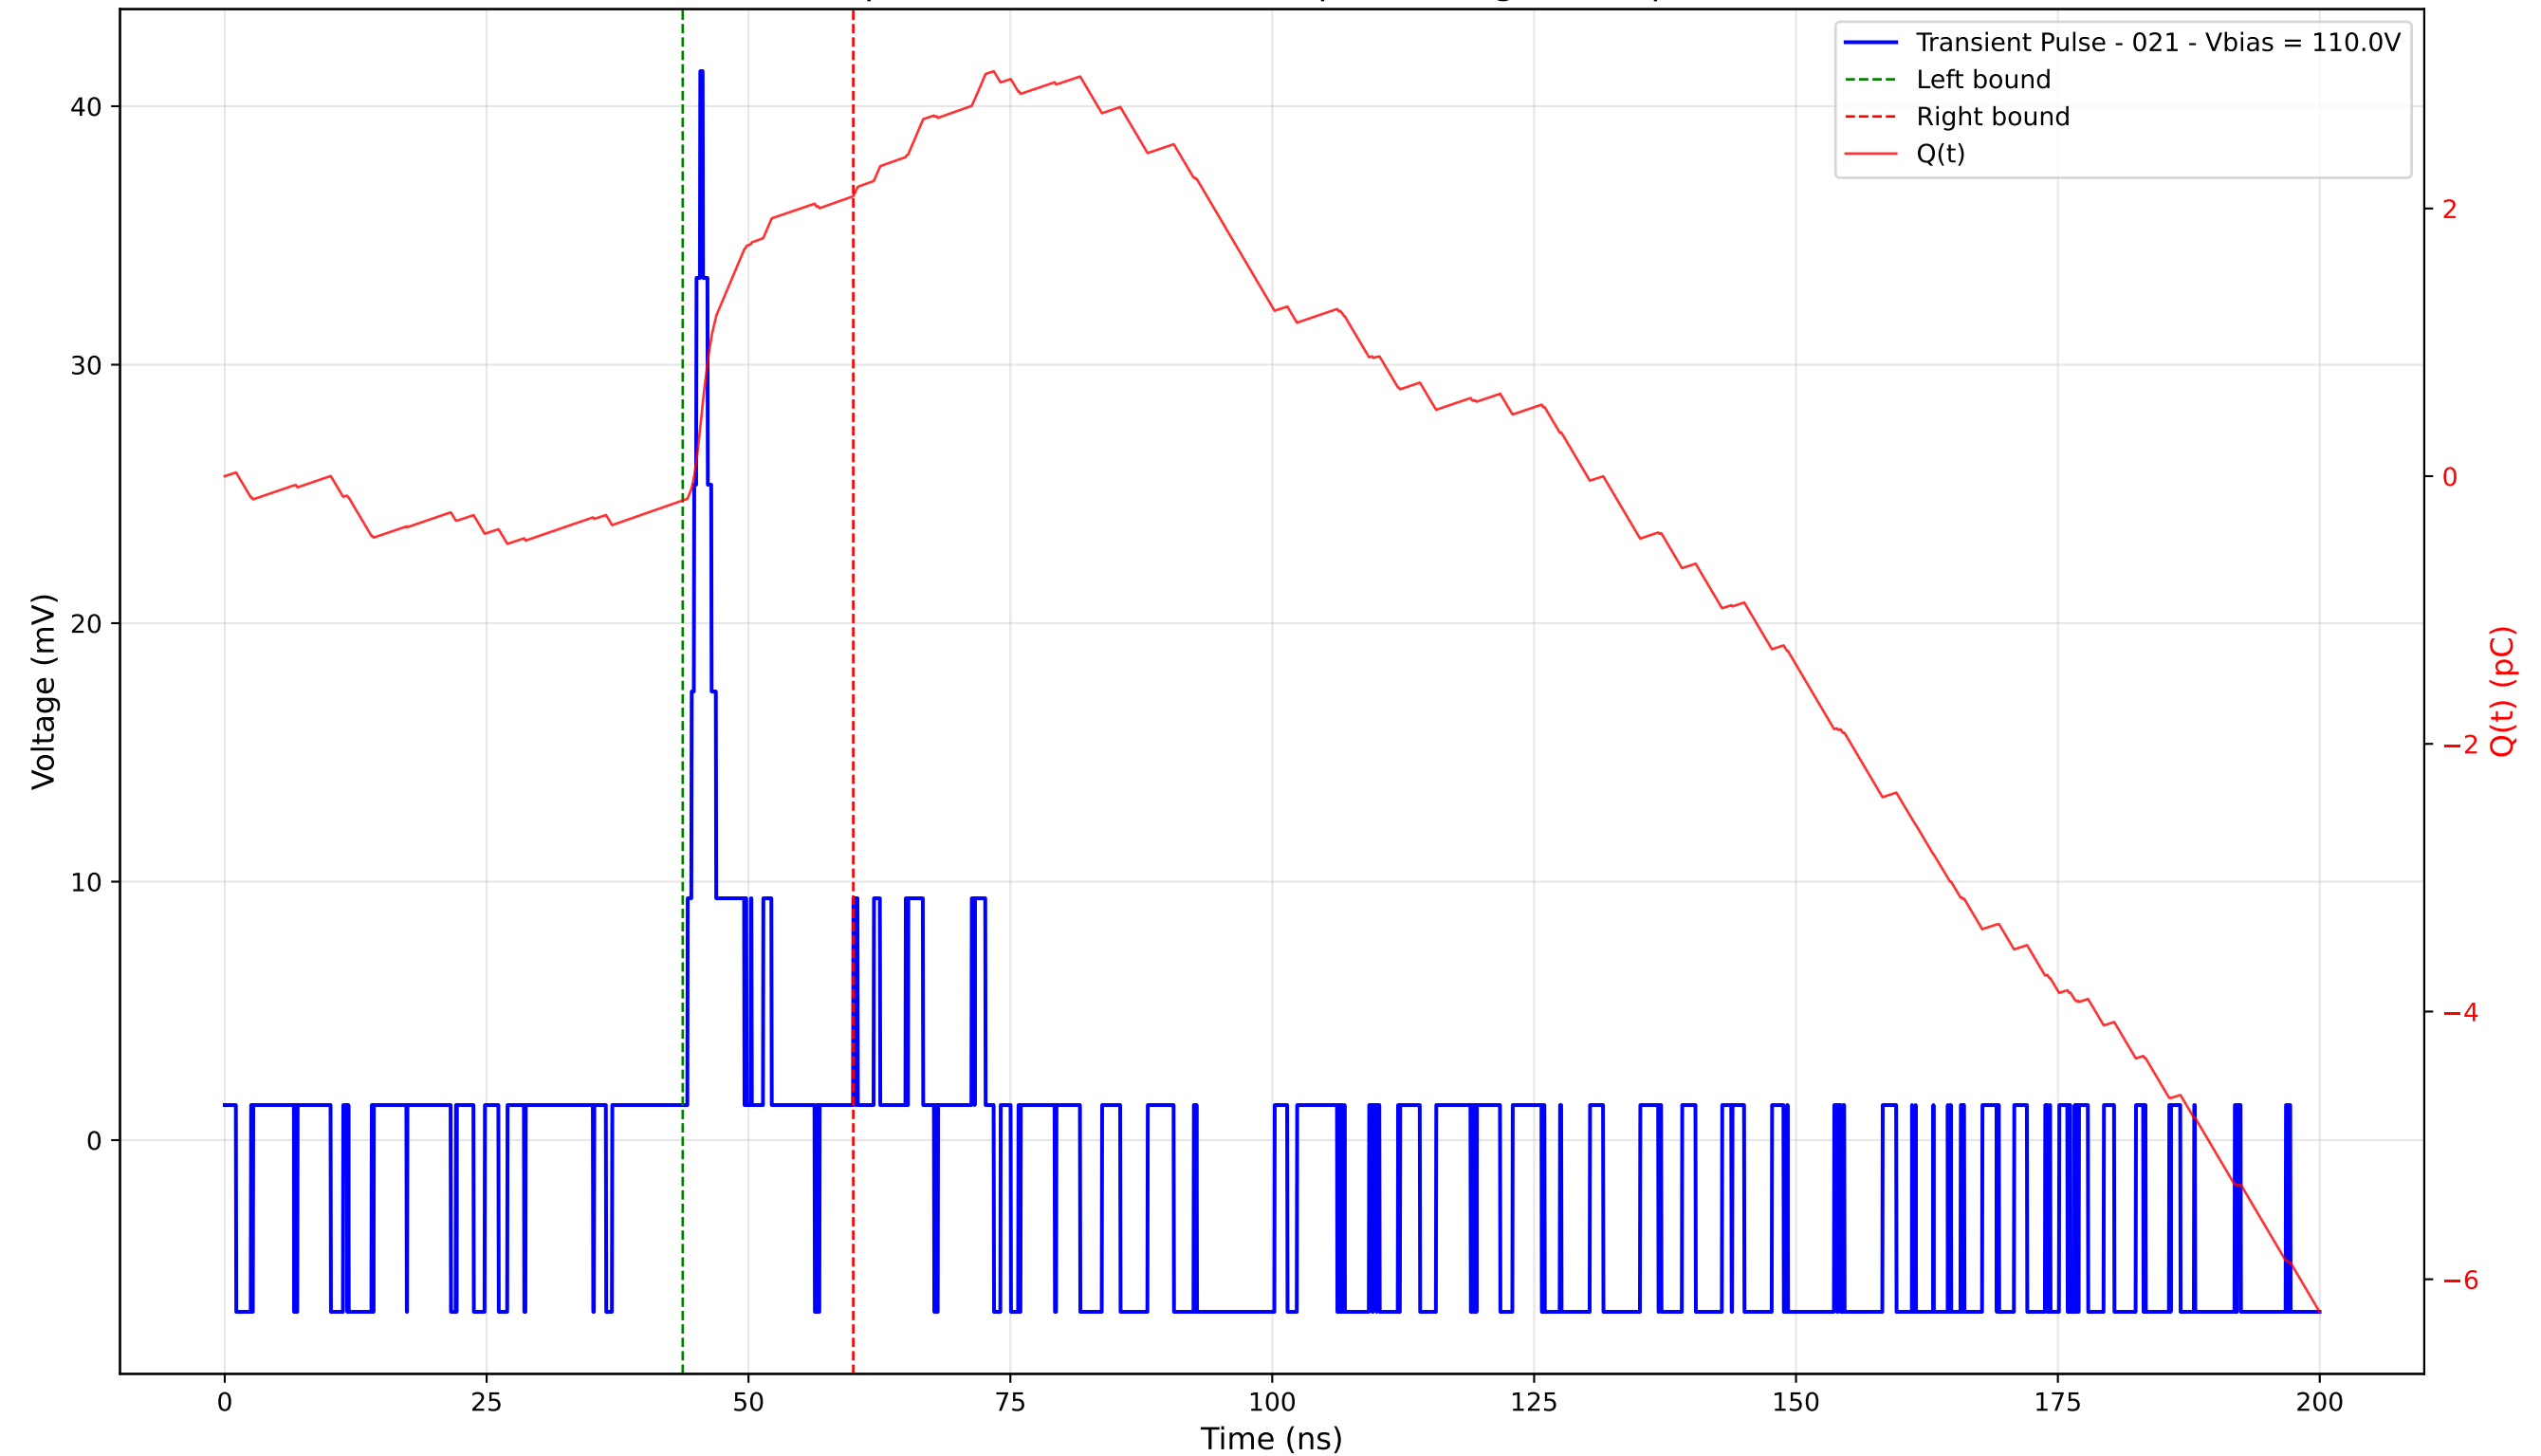


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 4.09 pC - Rise Time: 0.99 ns

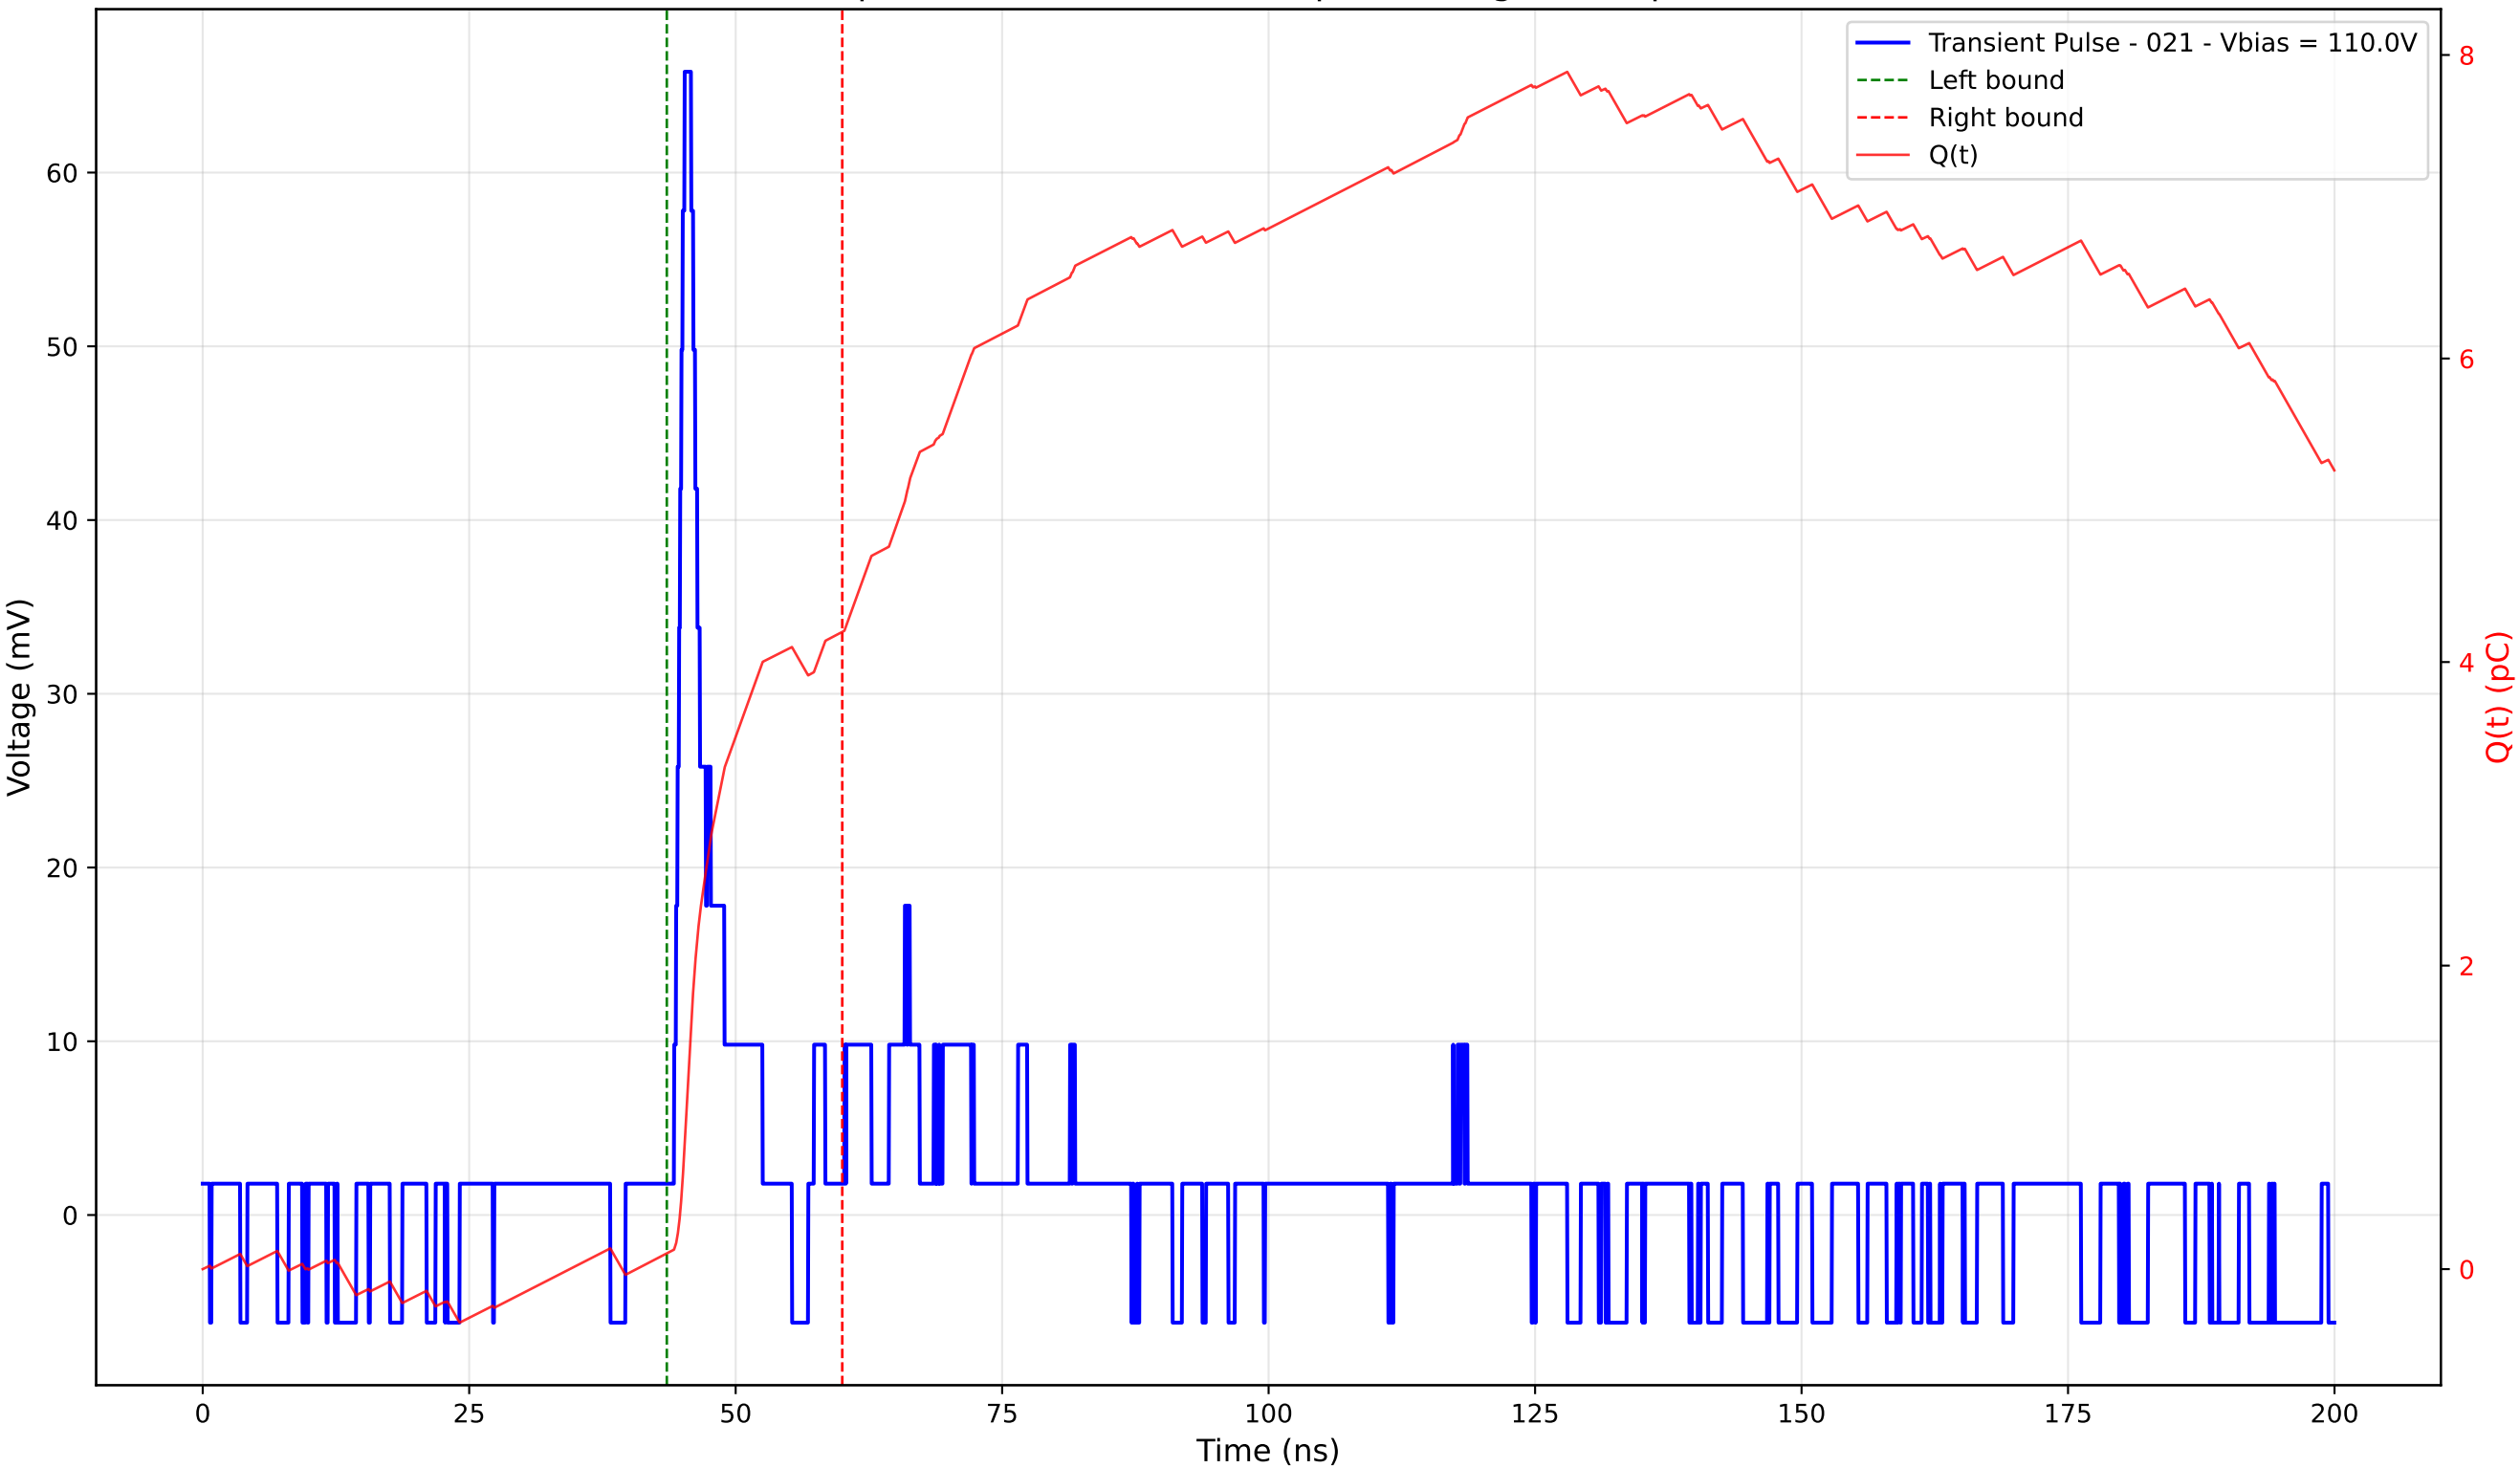


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 6.53 pC - Rise Time: 0.90 ns

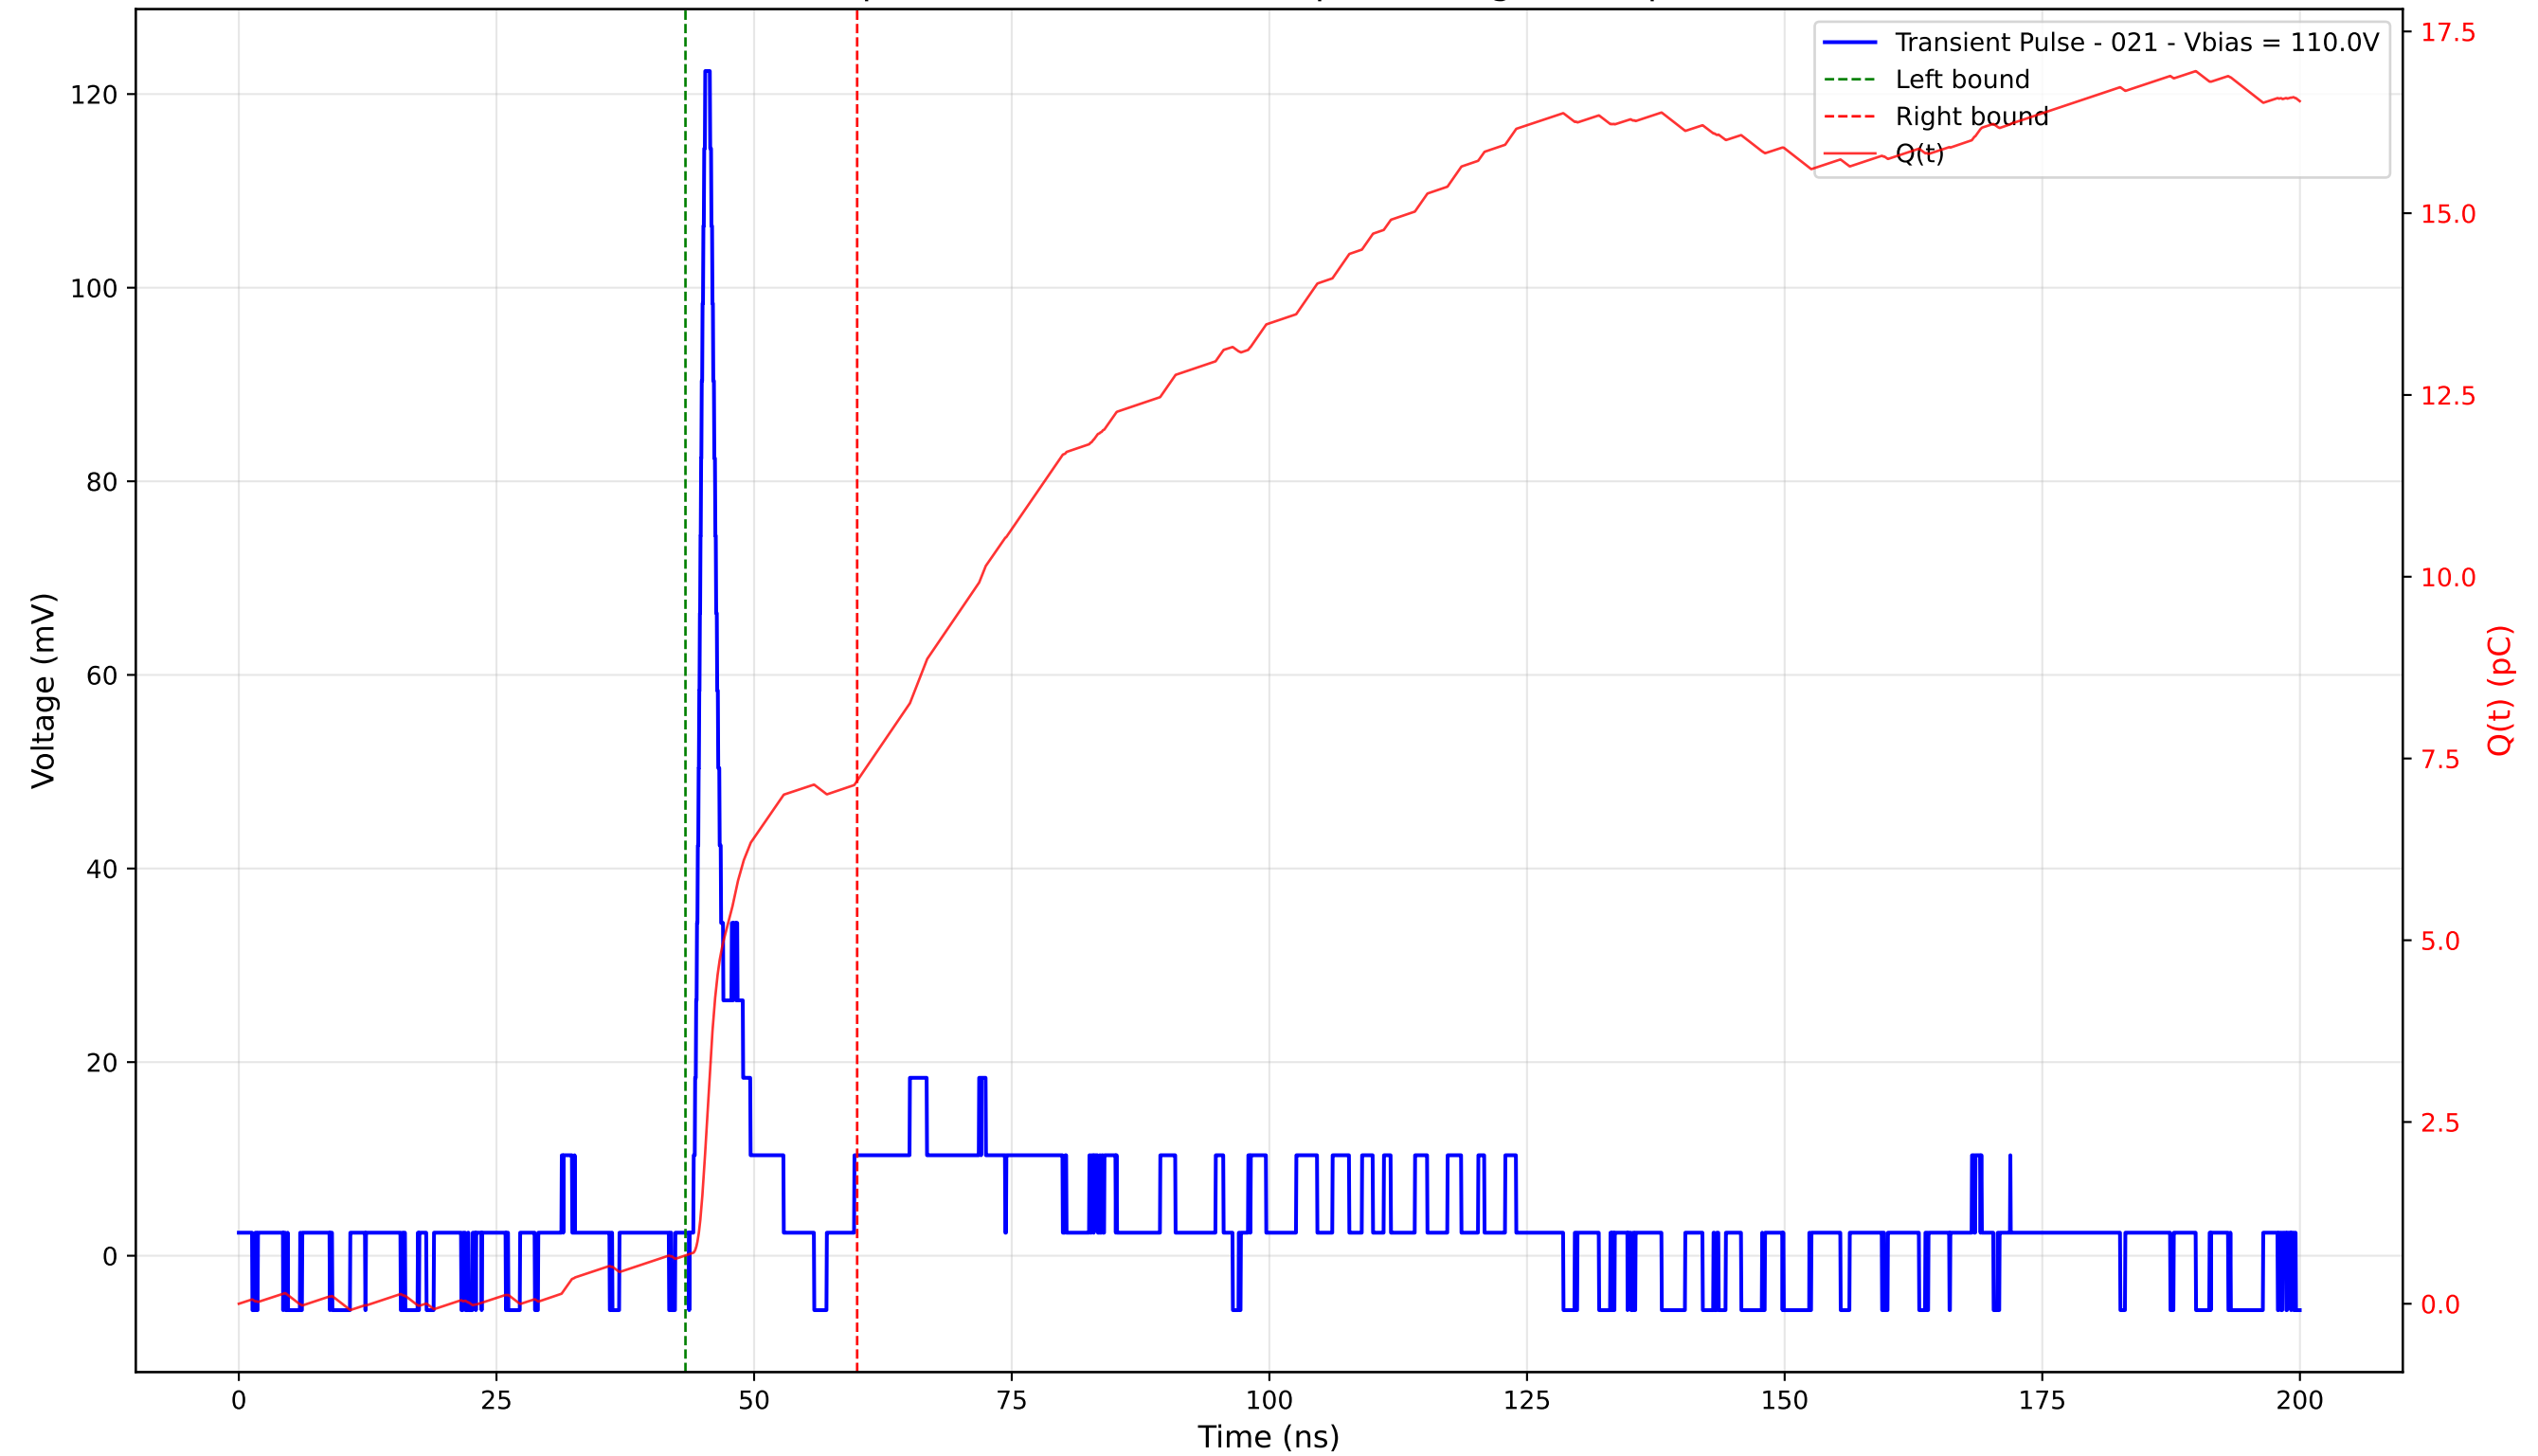


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 10.34 pC - Rise Time: 0.91 ns

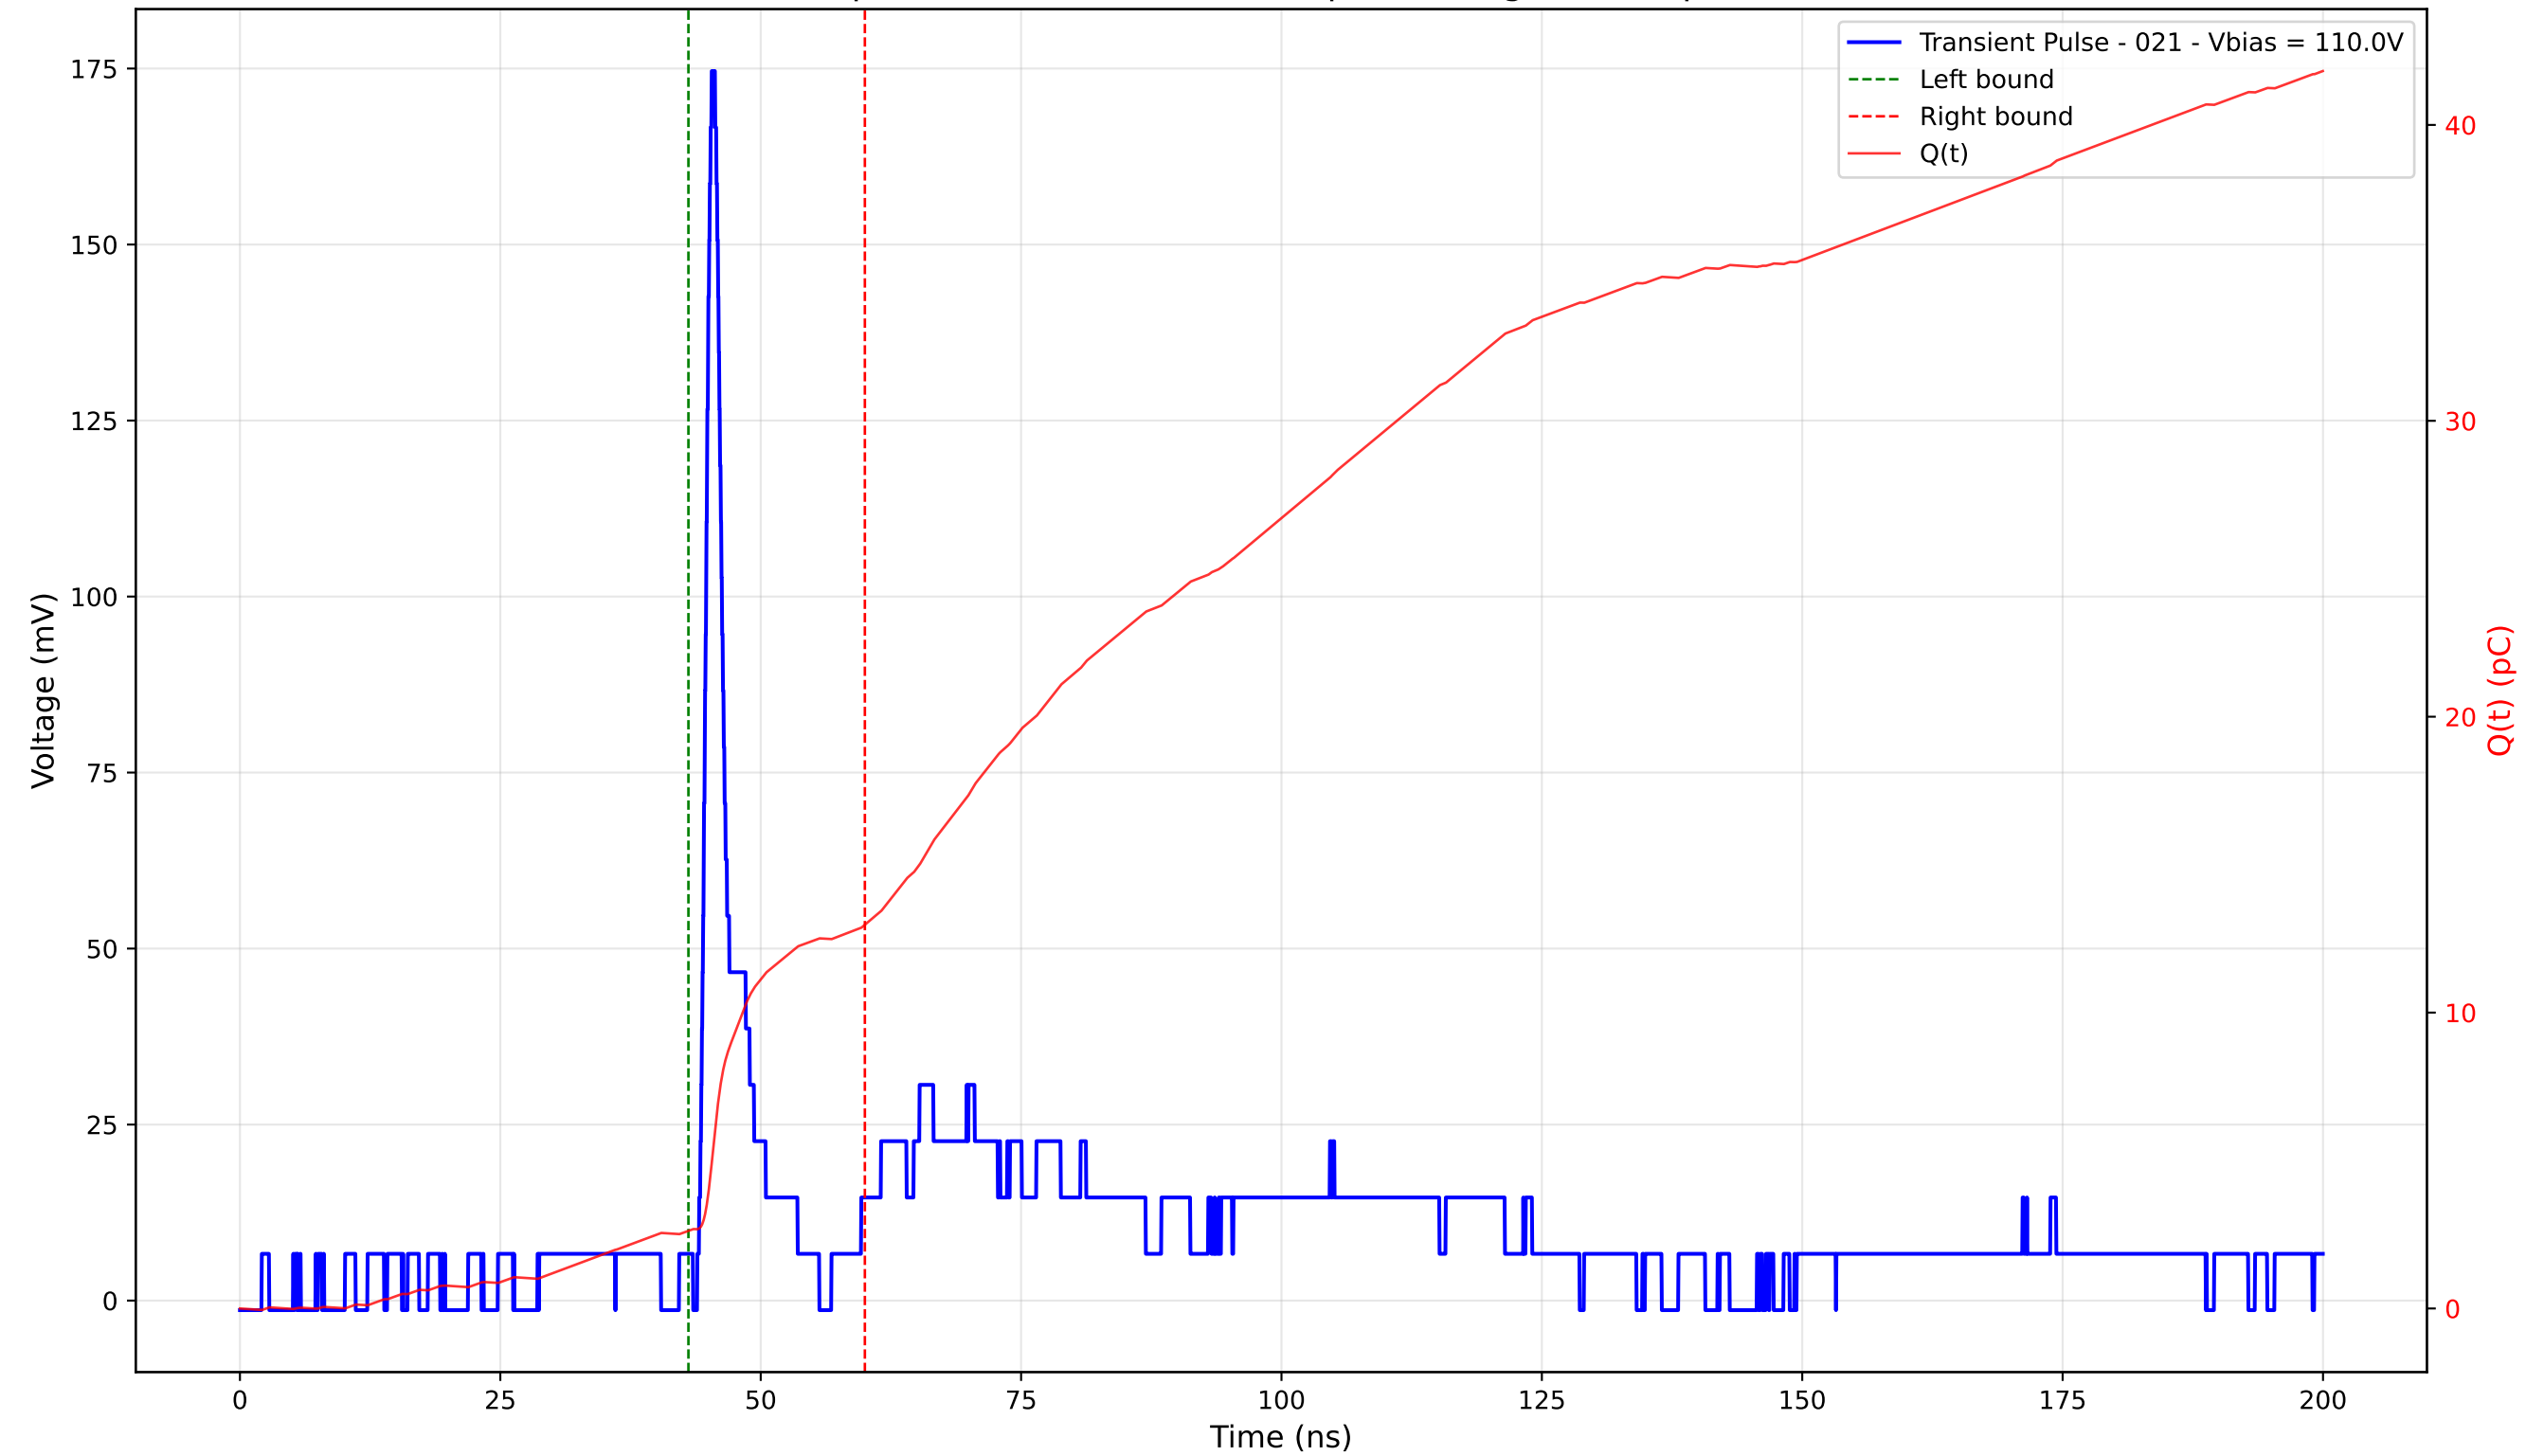


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 12.16 pC - Rise Time: 0.95 ns

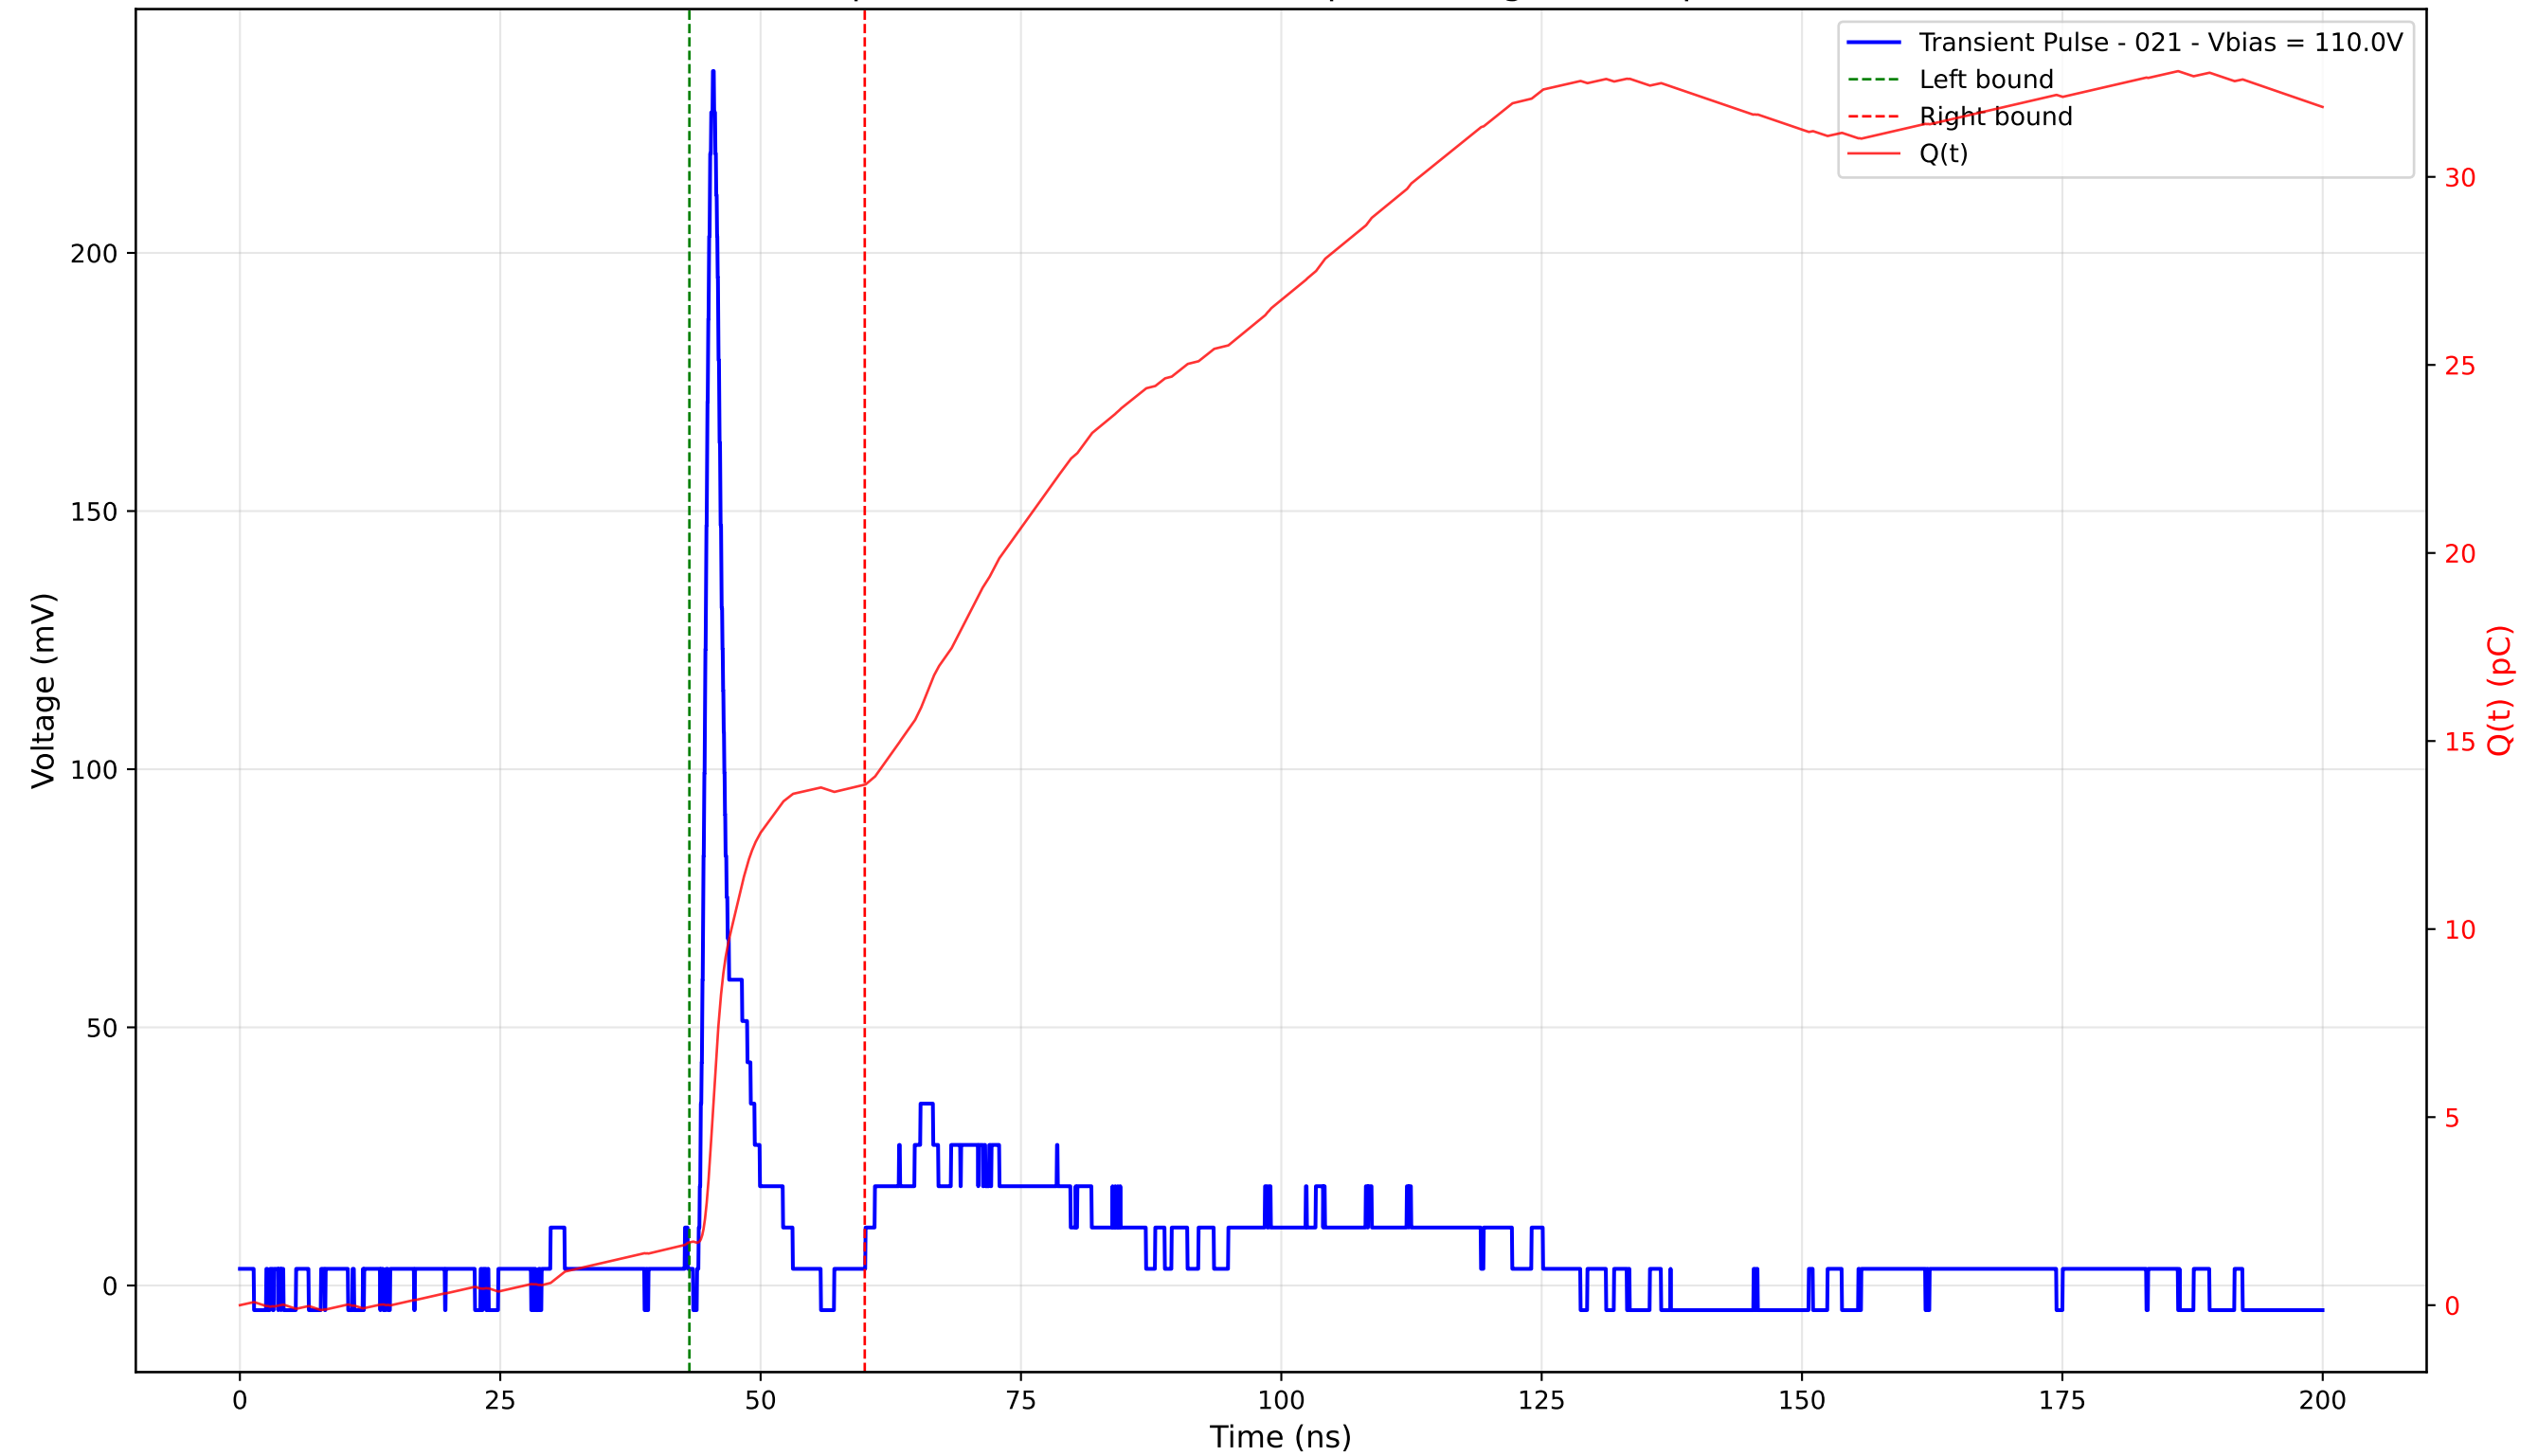


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 15.83 pC - Rise Time: 0.94 ns

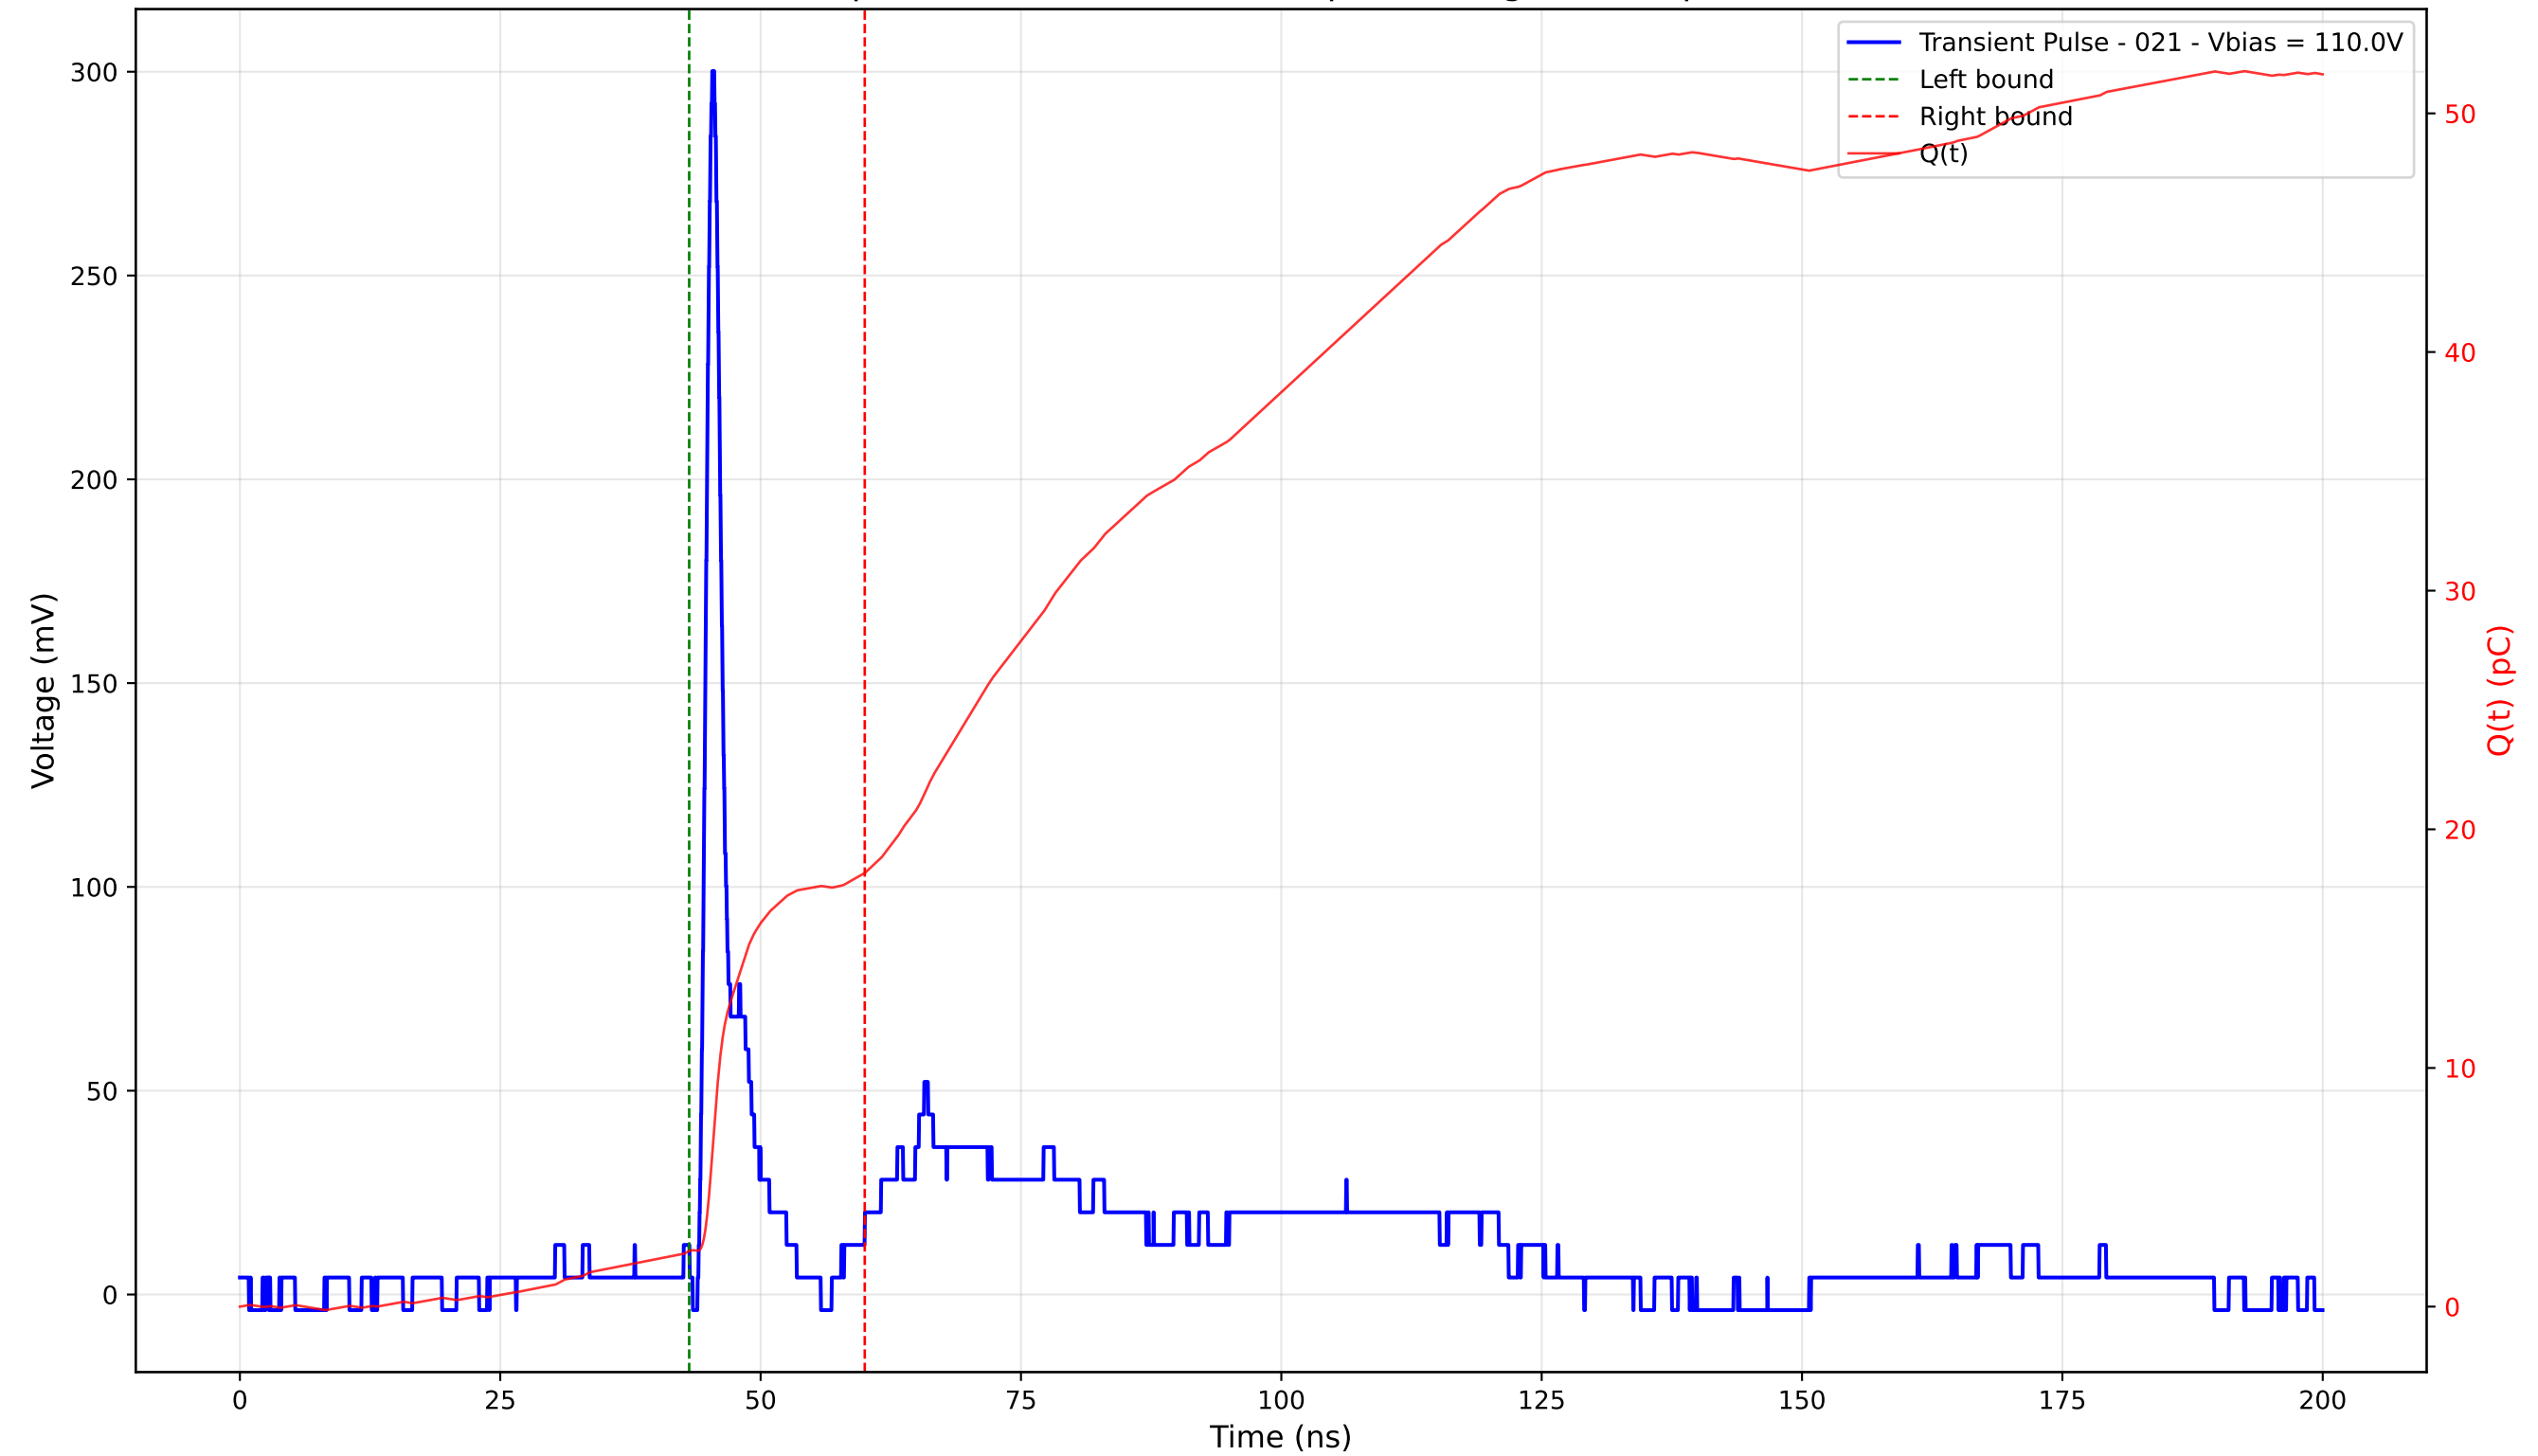


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 16.66 pC - Rise Time: 0.88 ns

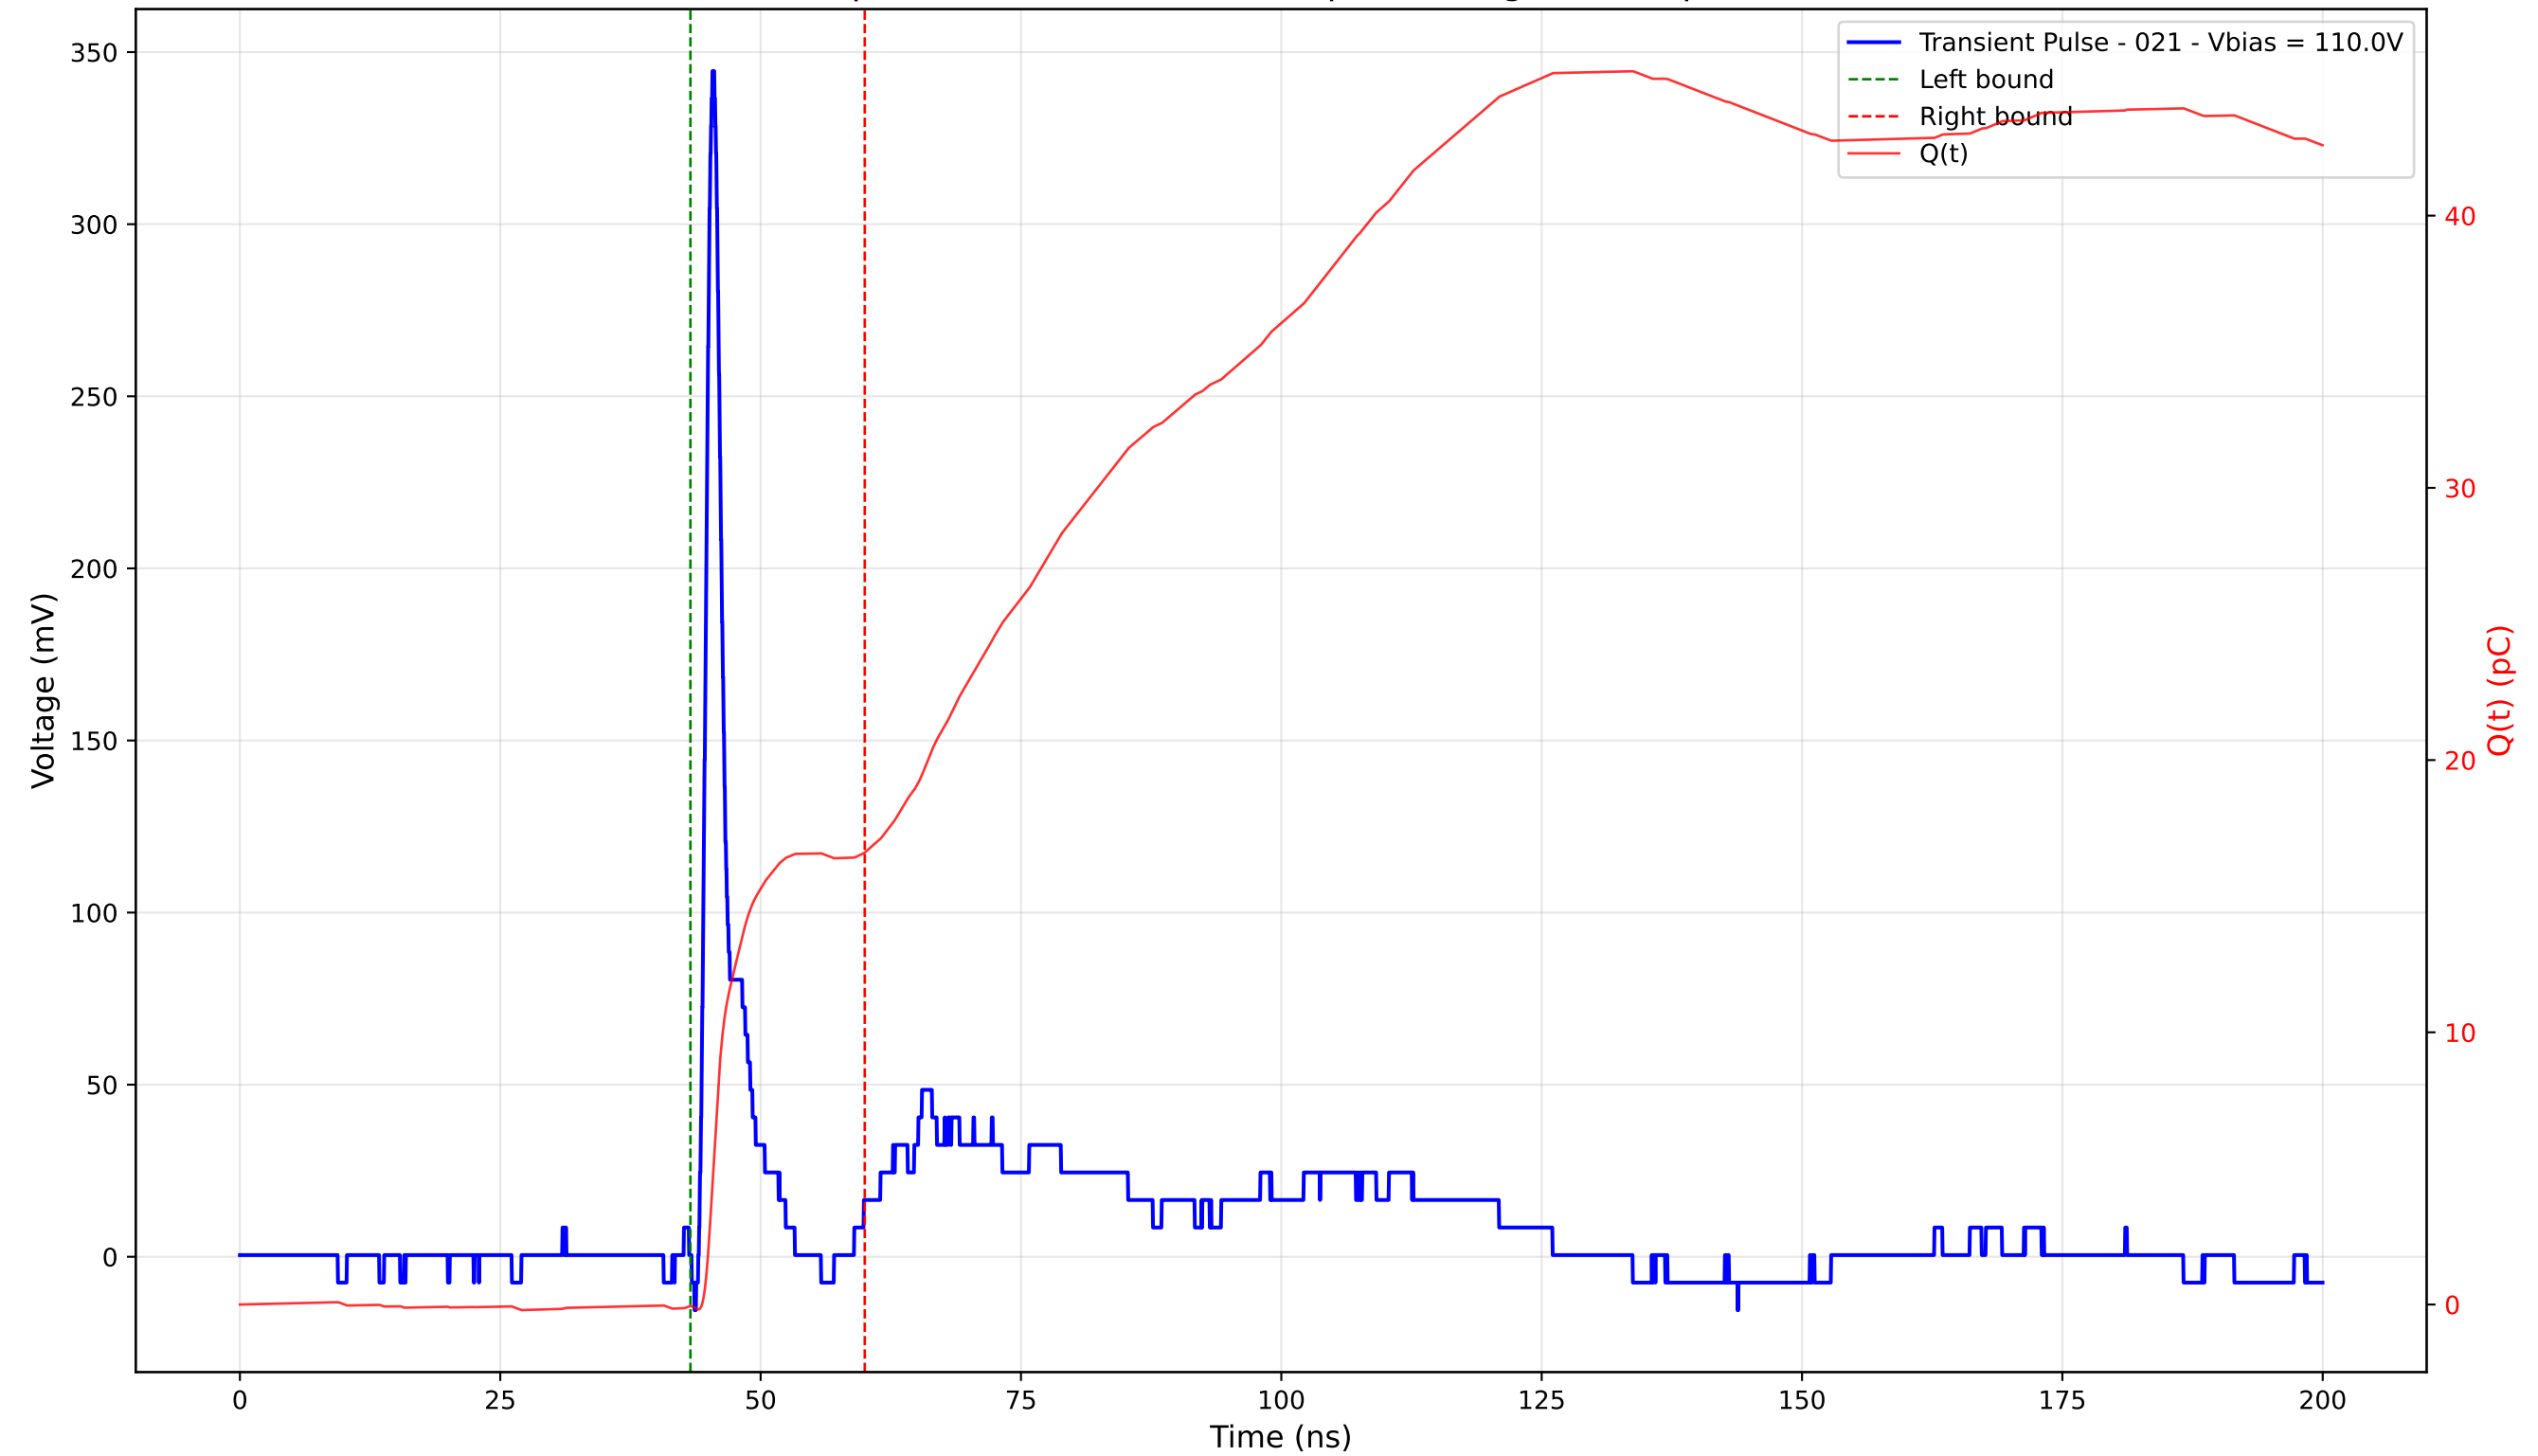


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 18.74 pC - Rise Time: 0.90 ns

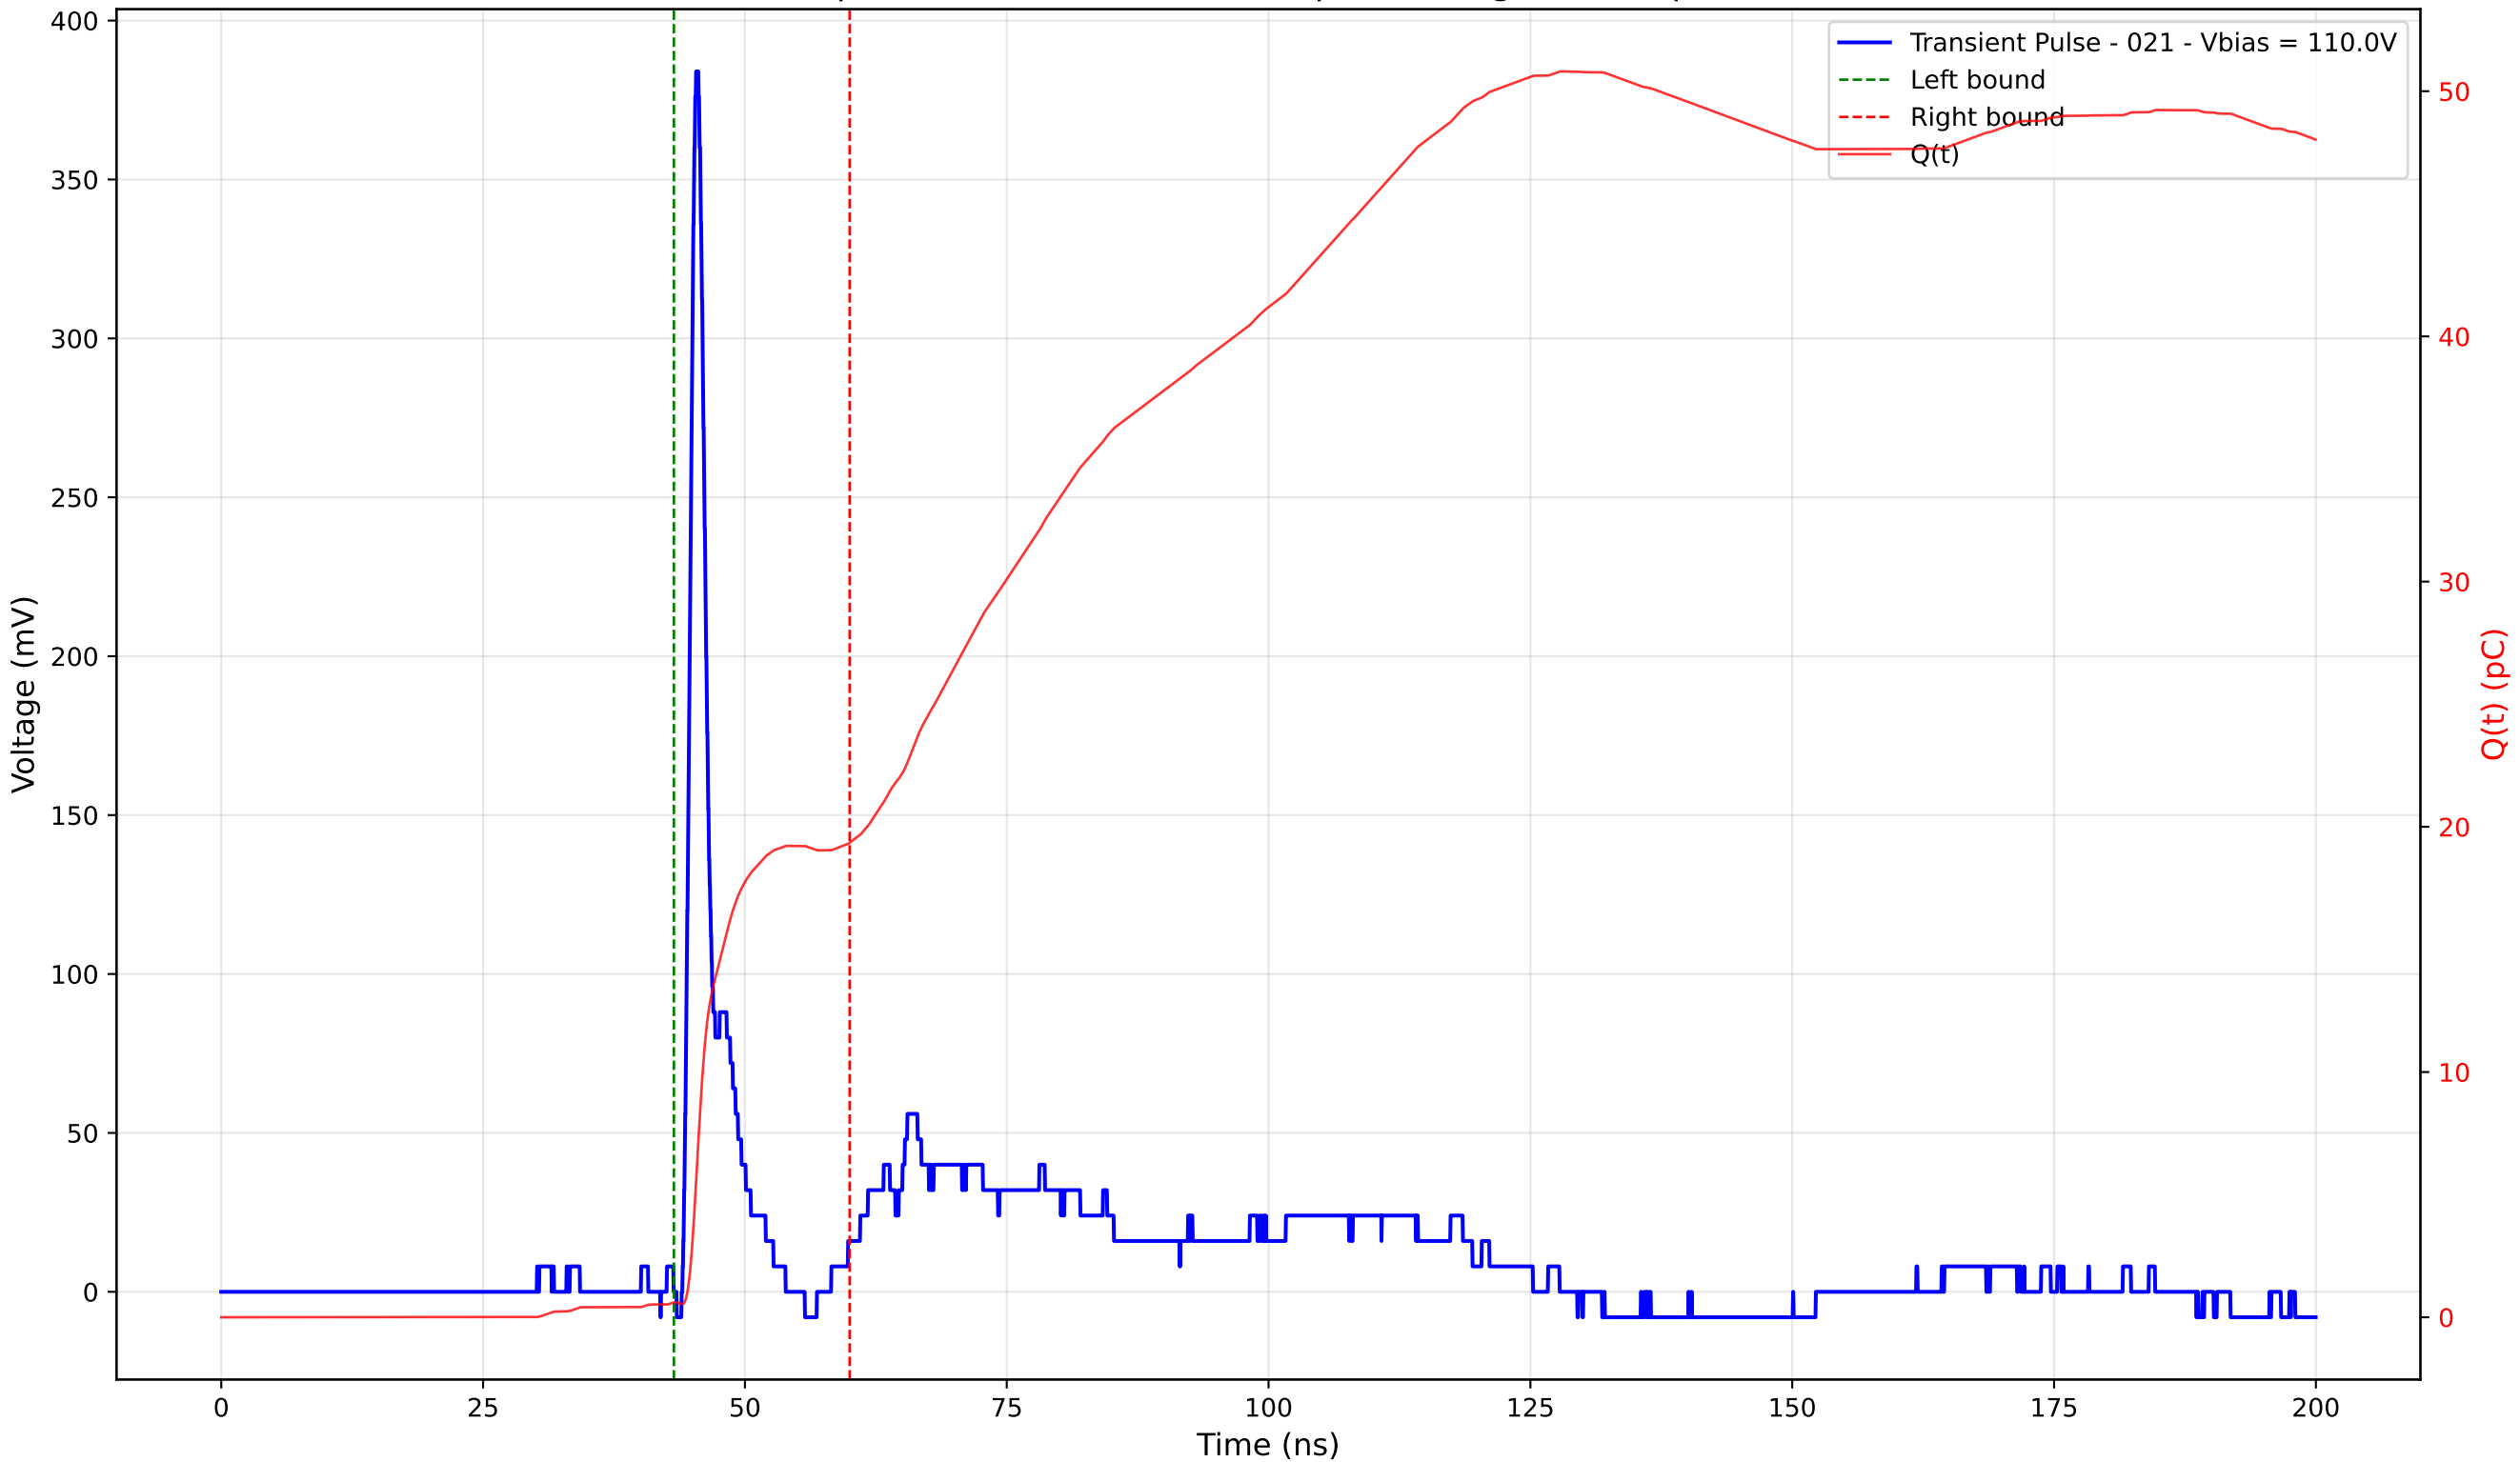


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 20.22 pC - Rise Time: 0.90 ns

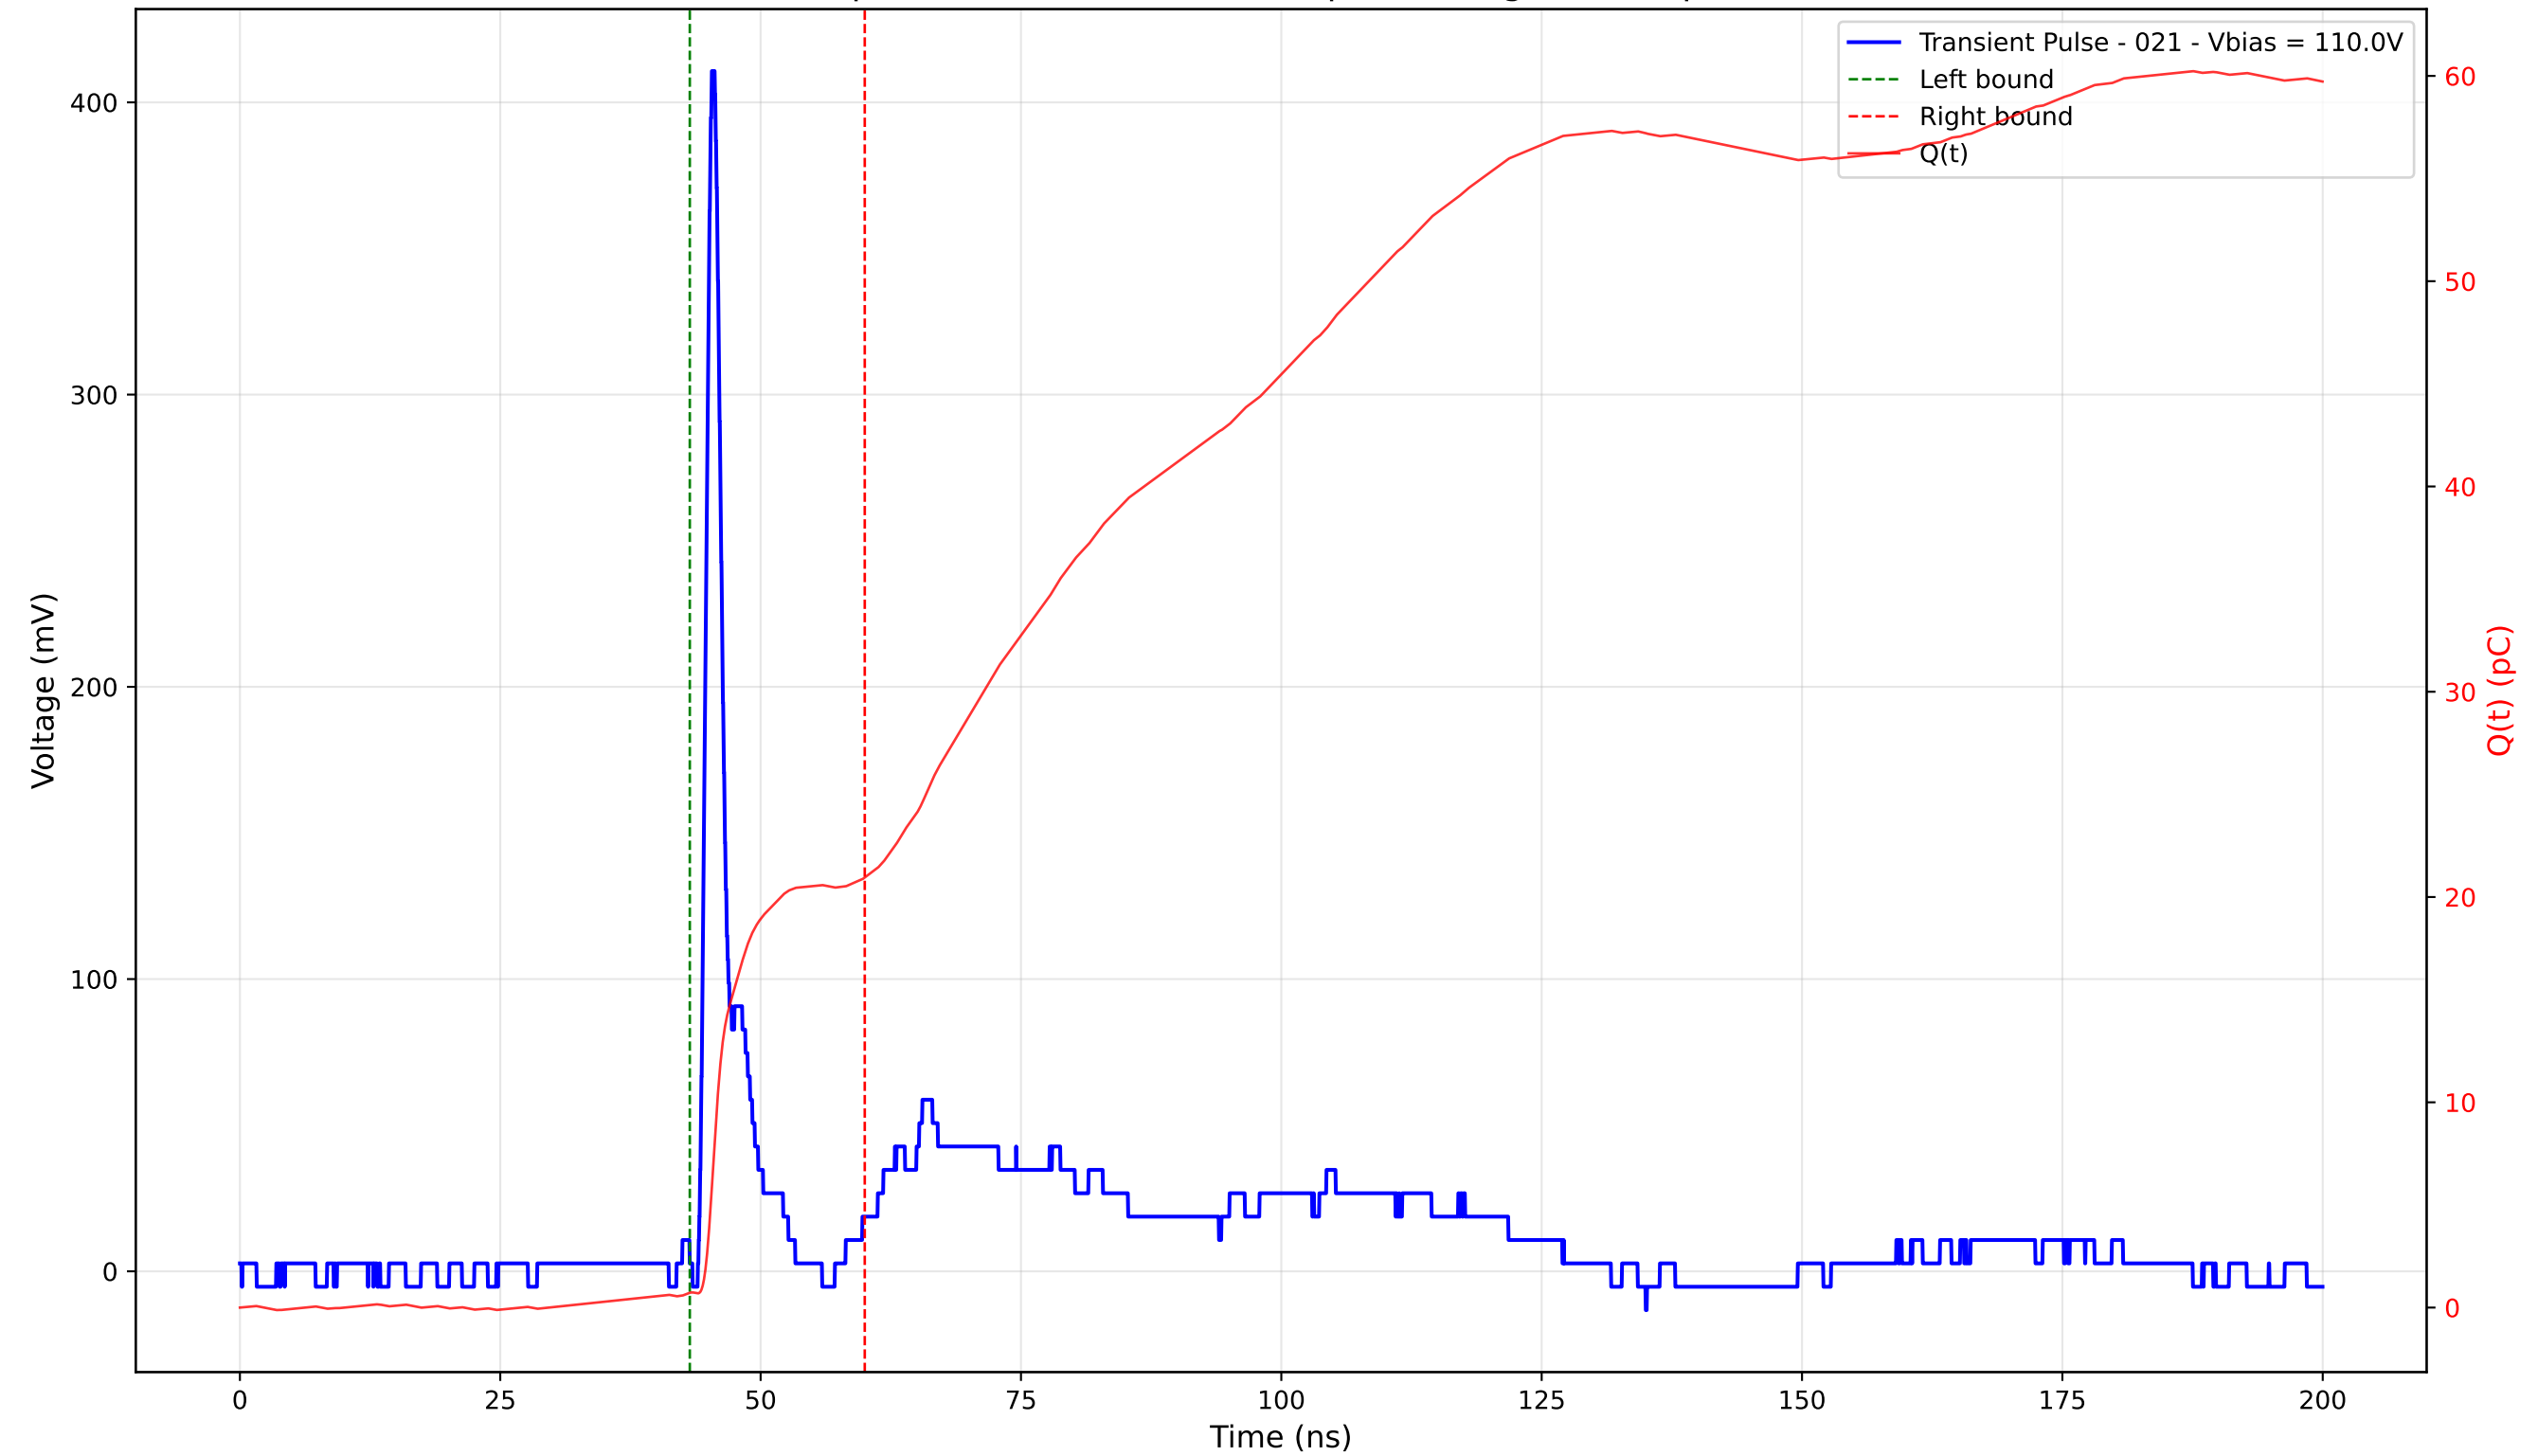


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 19.89 pC - Rise Time: 0.92 ns

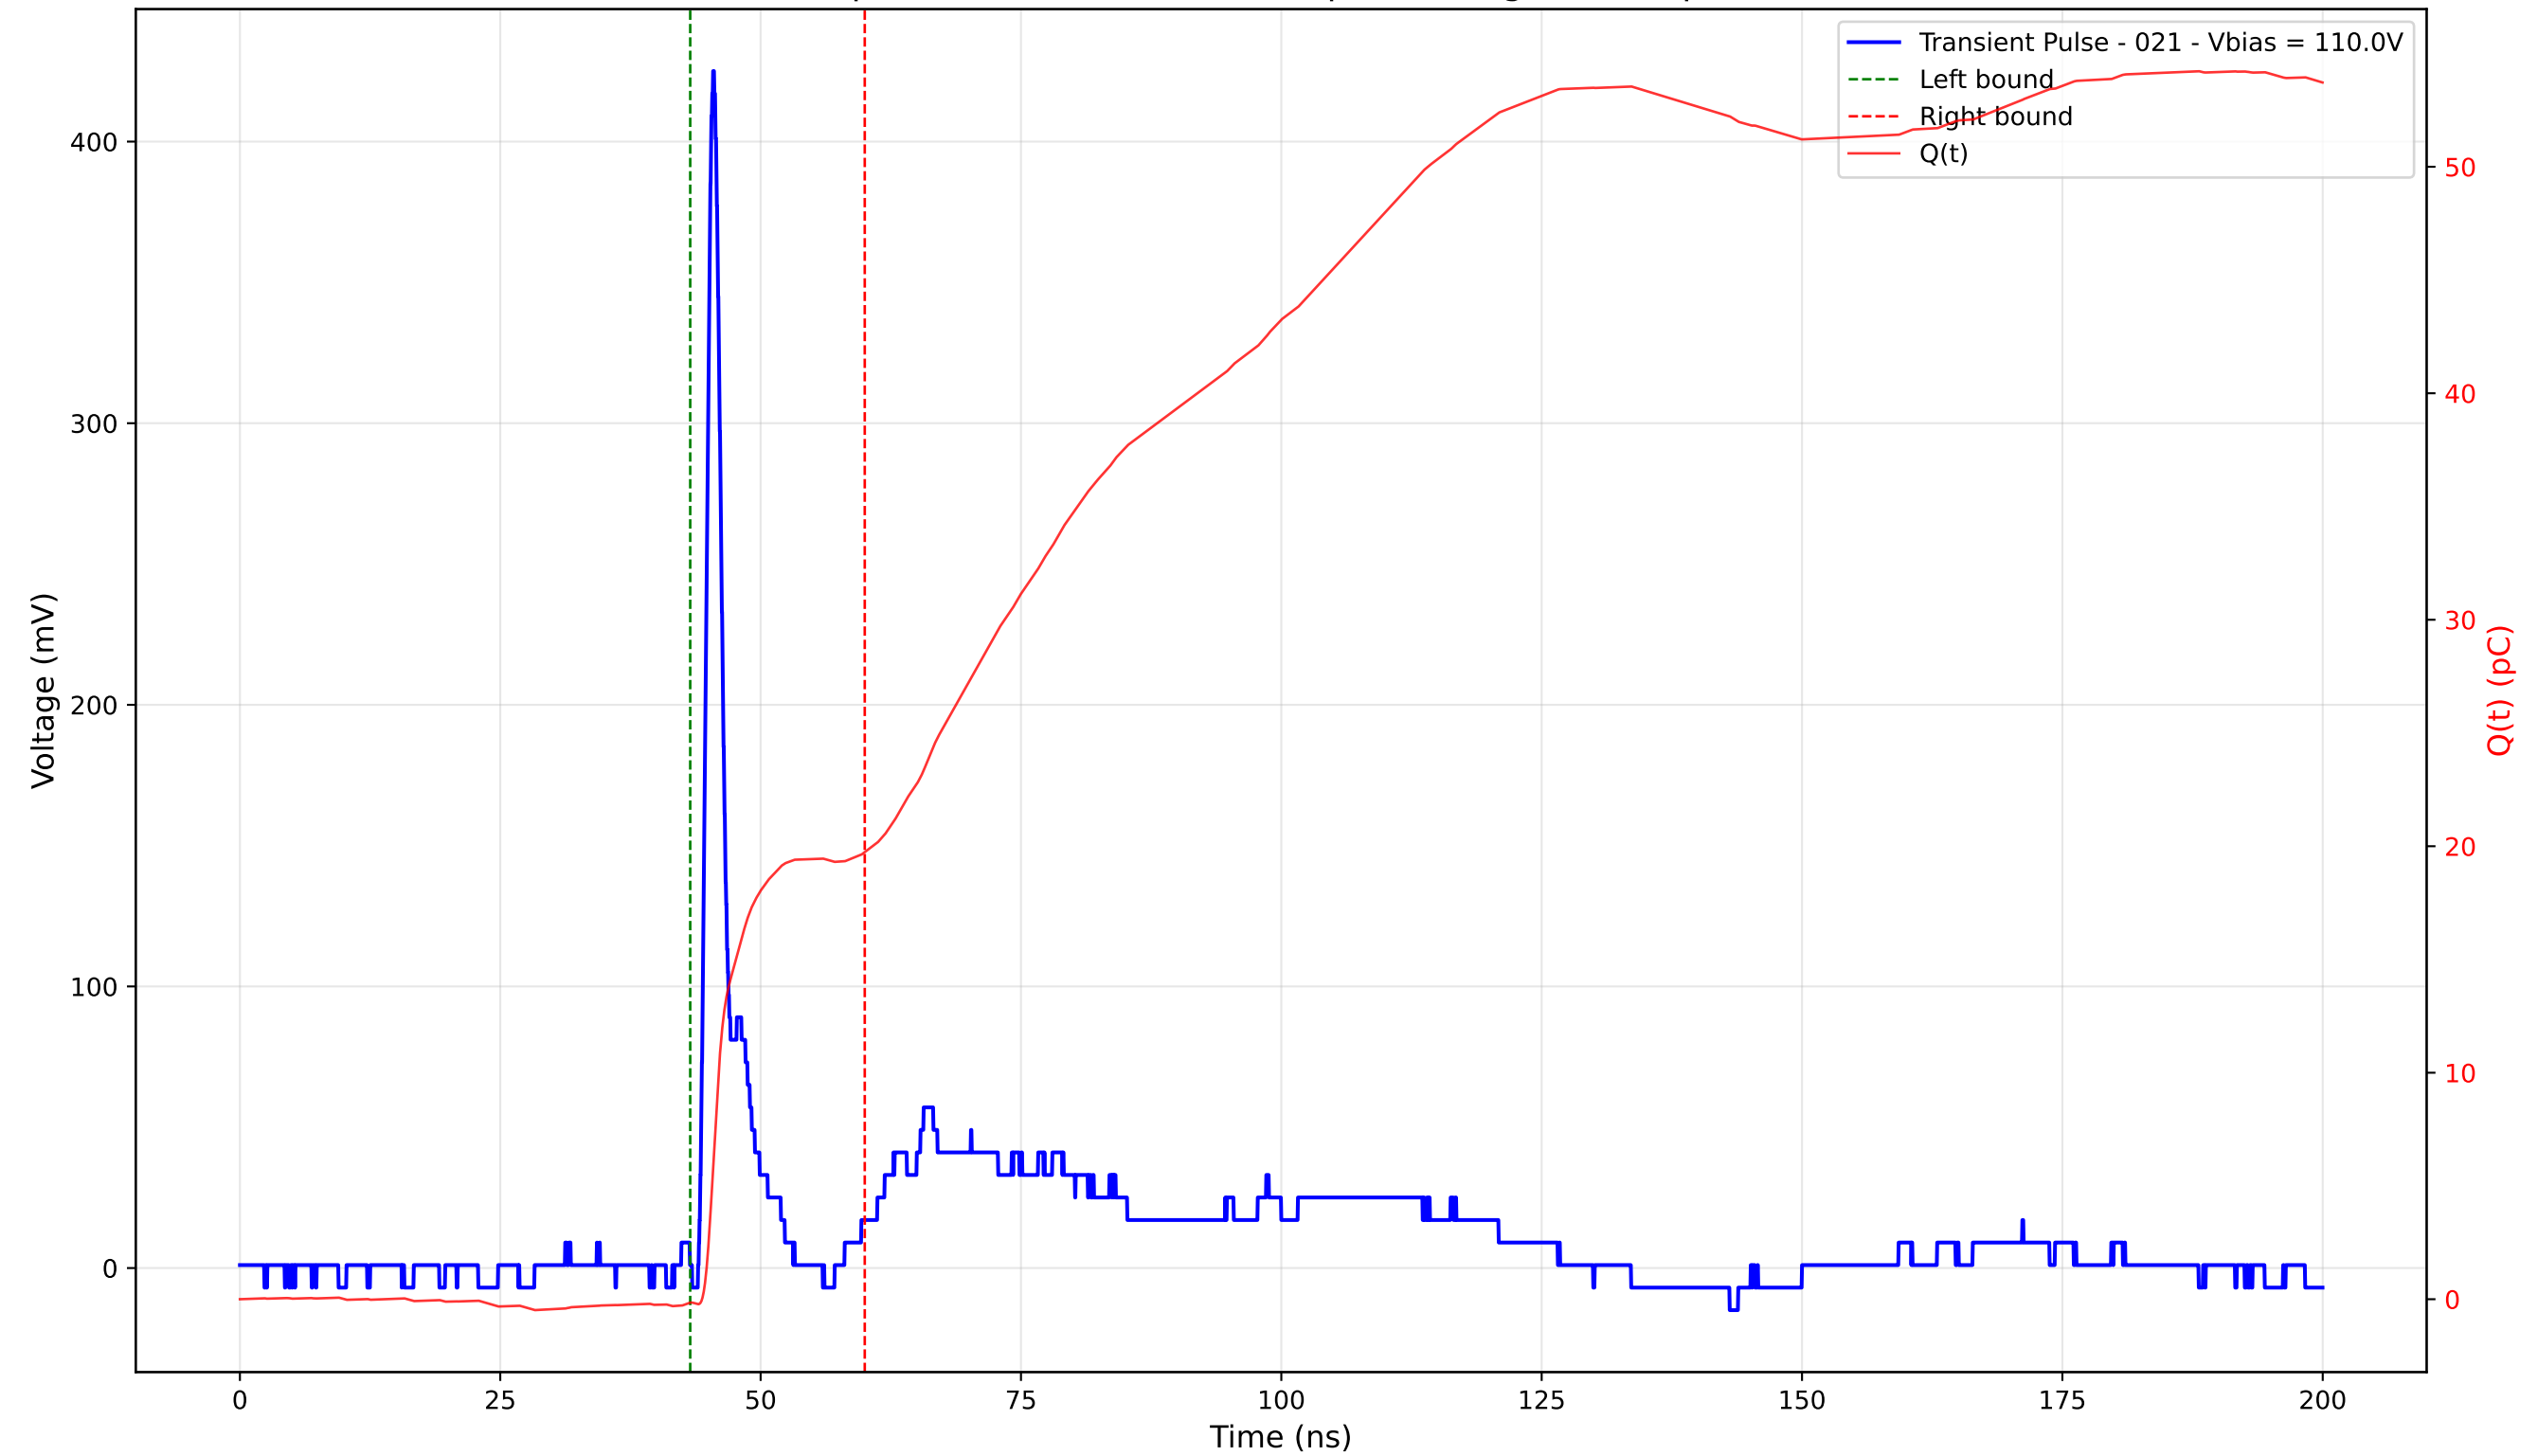


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 20.35 pC - Rise Time: 0.94 ns

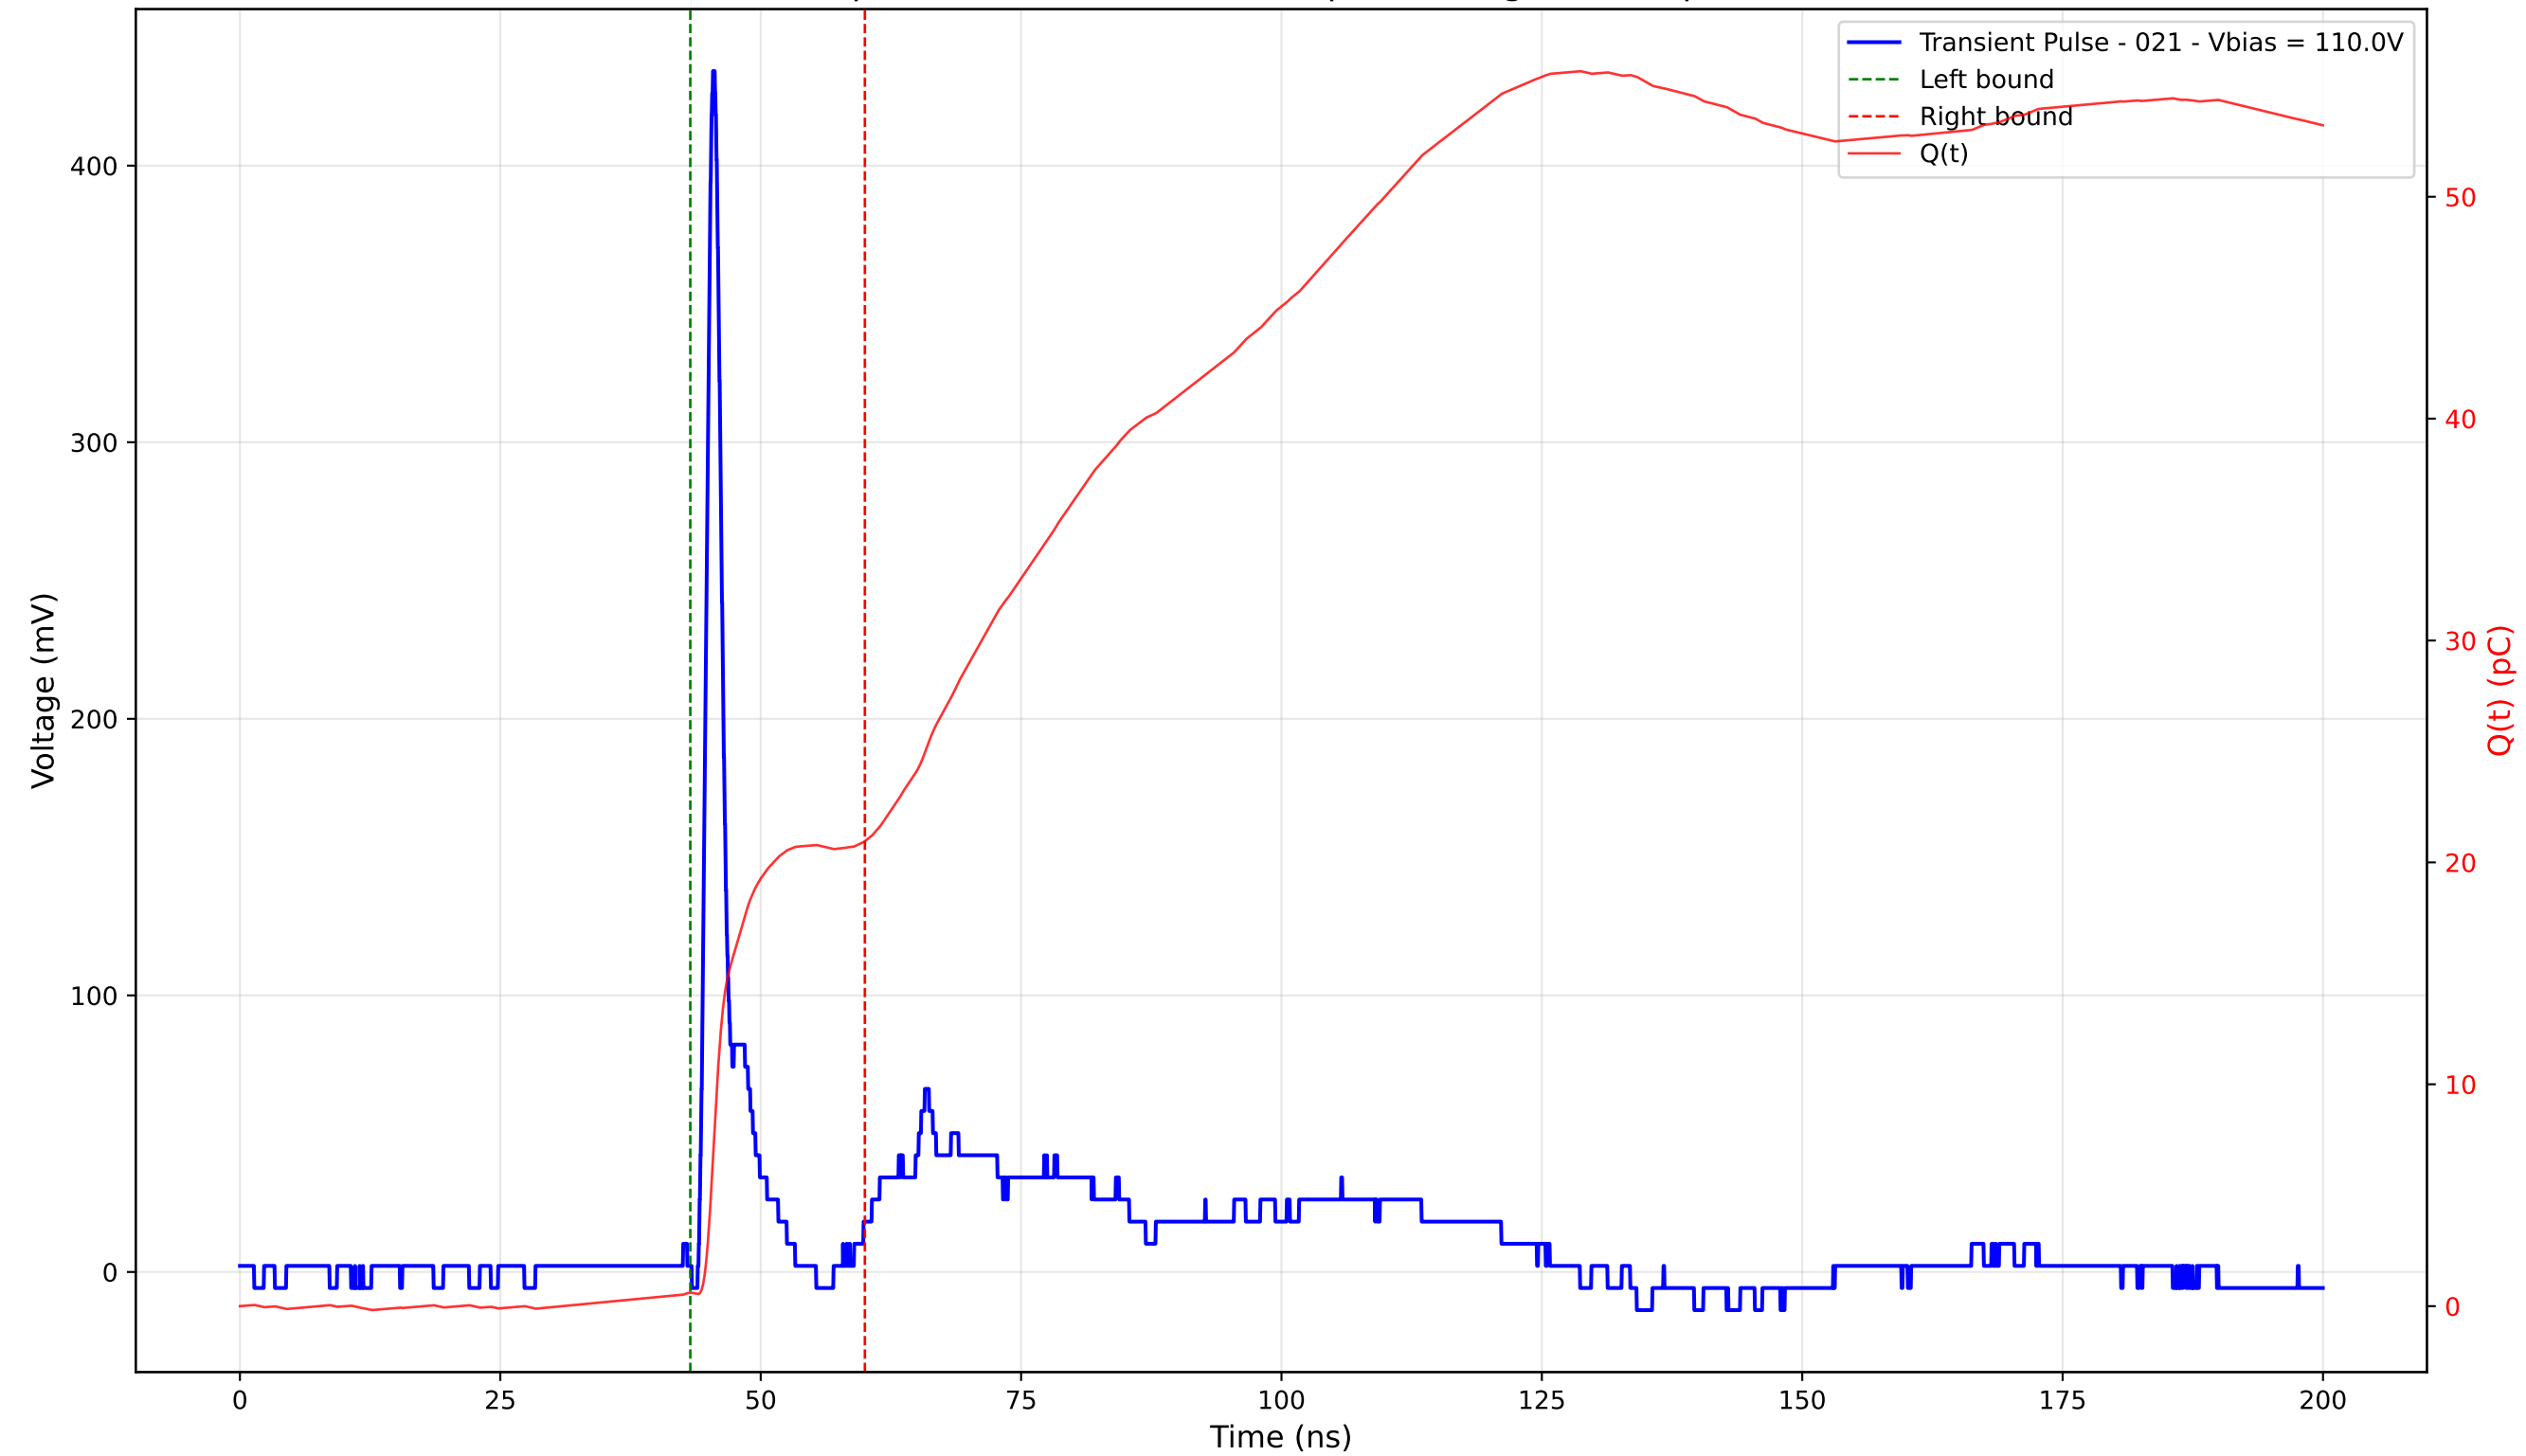


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 21.03 pC - Rise Time: 0.96 ns

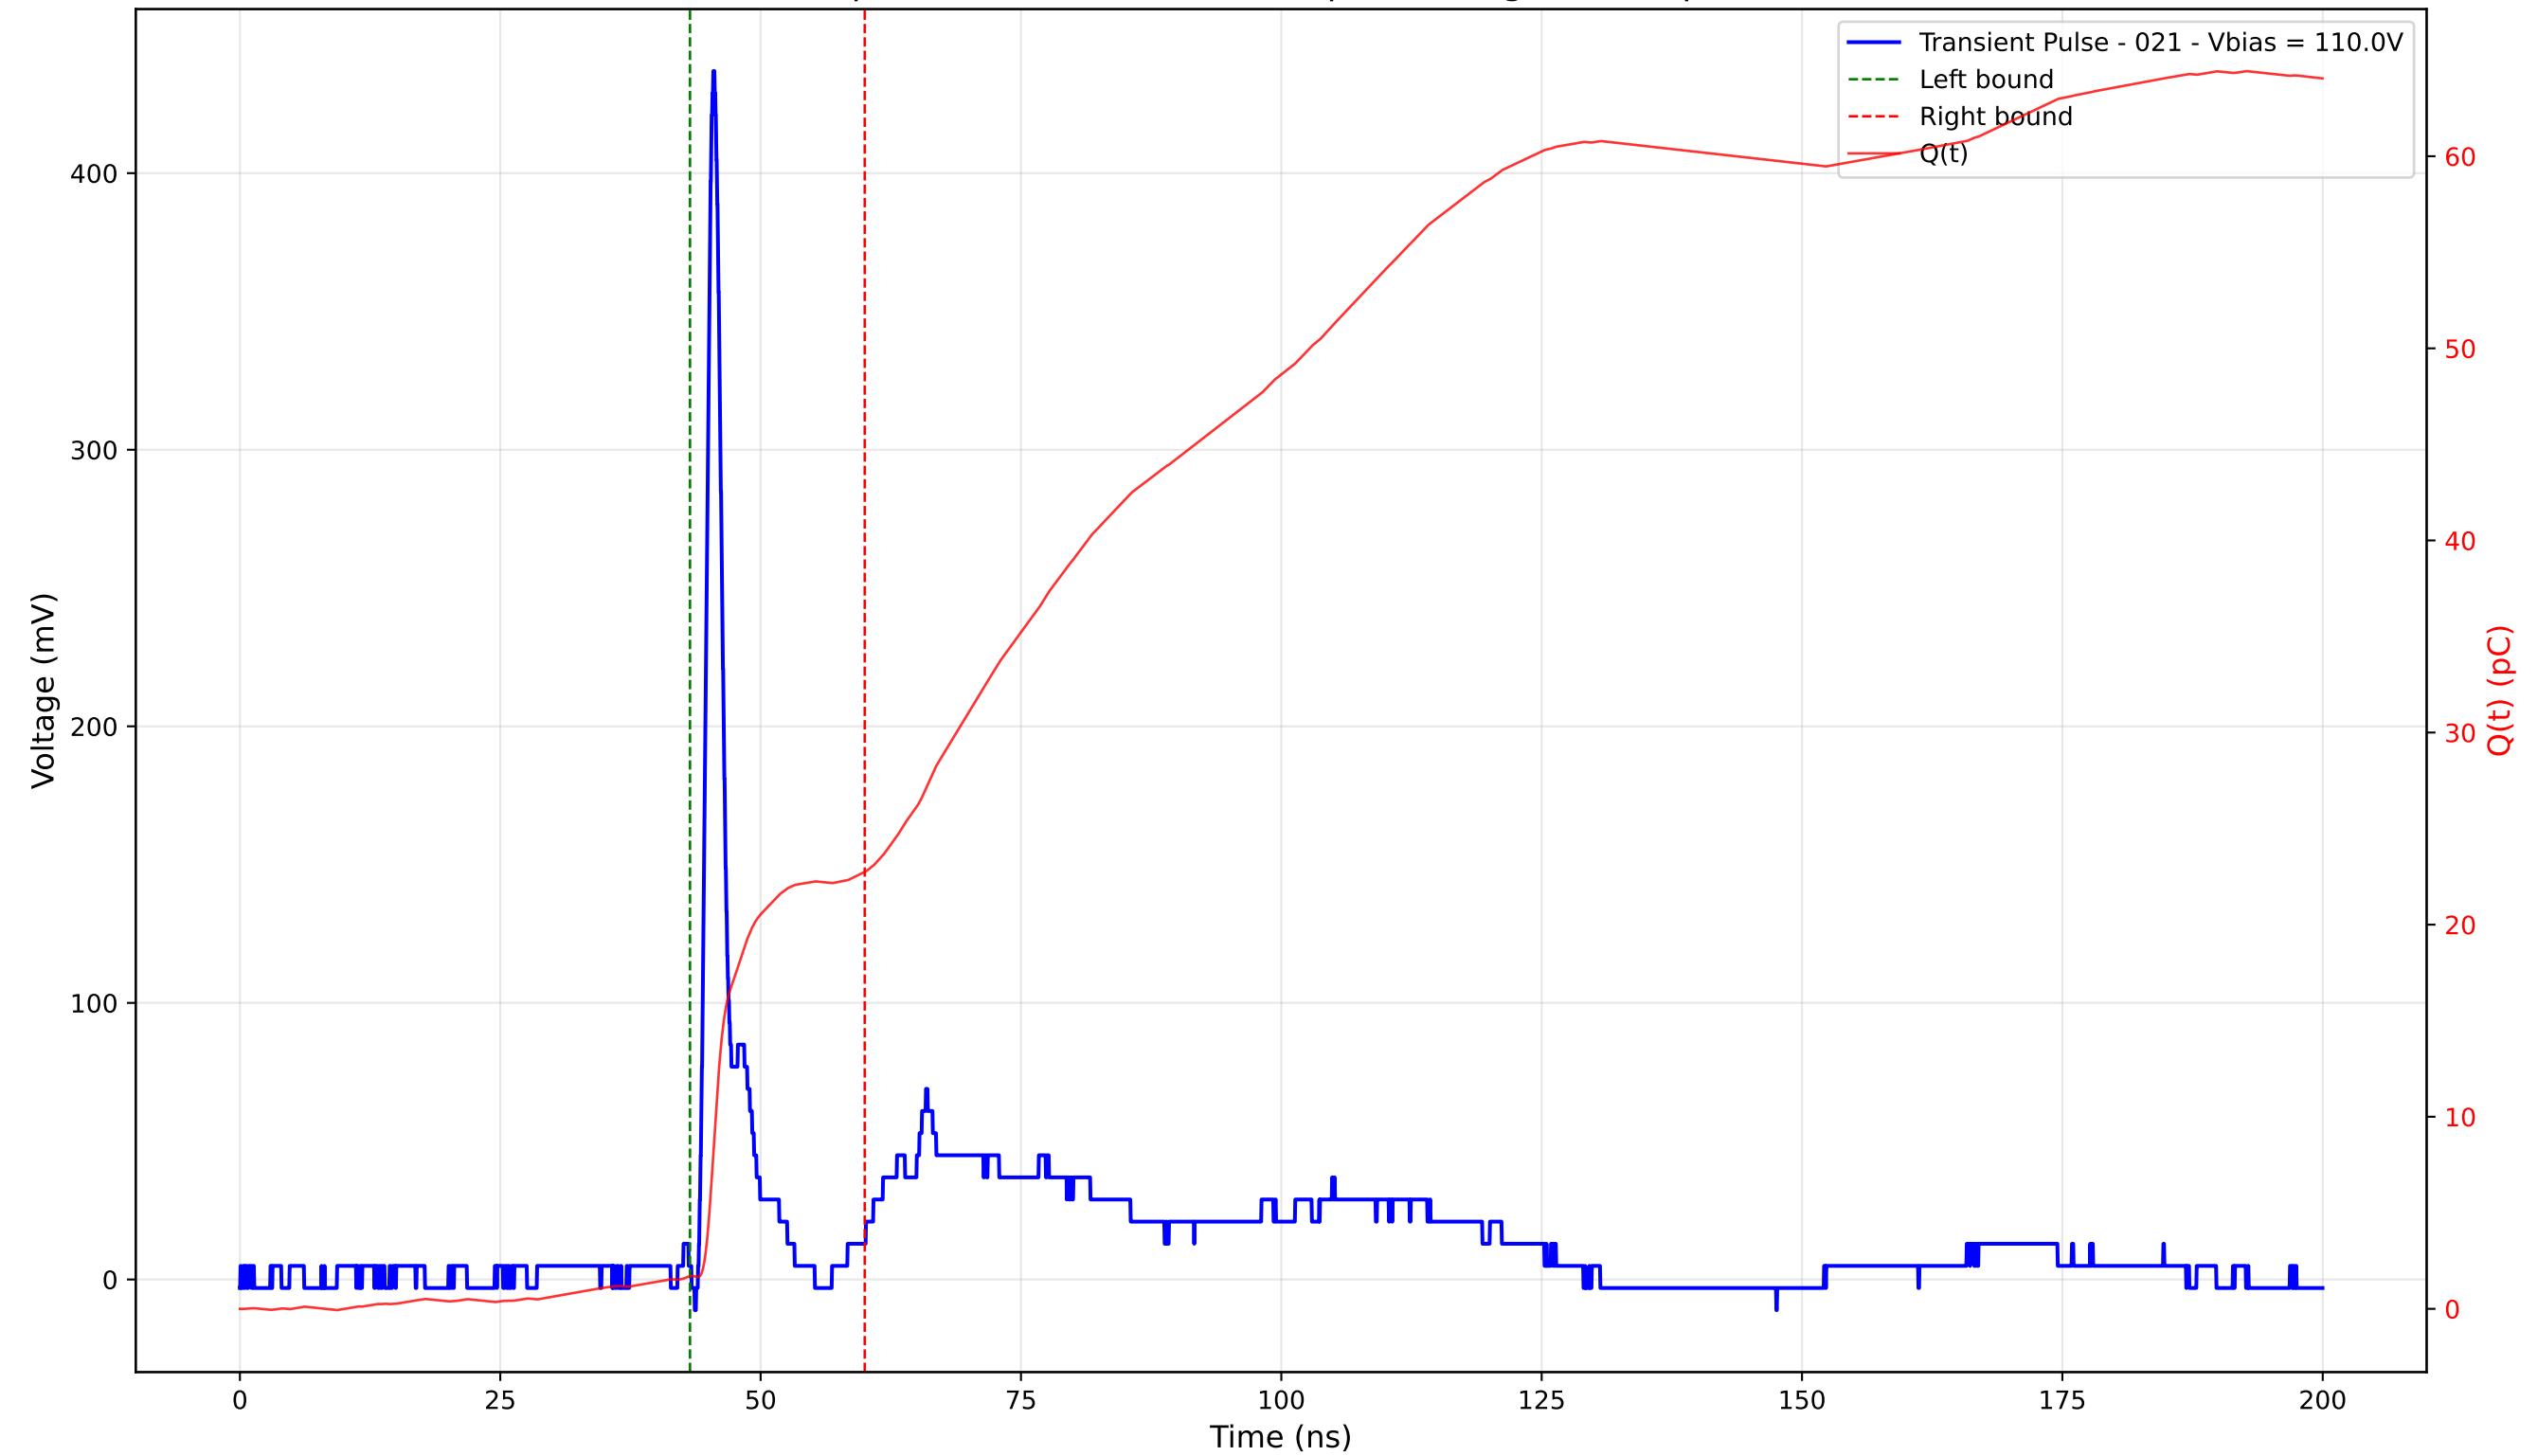


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 20.66 pC - Rise Time: 0.96 ns

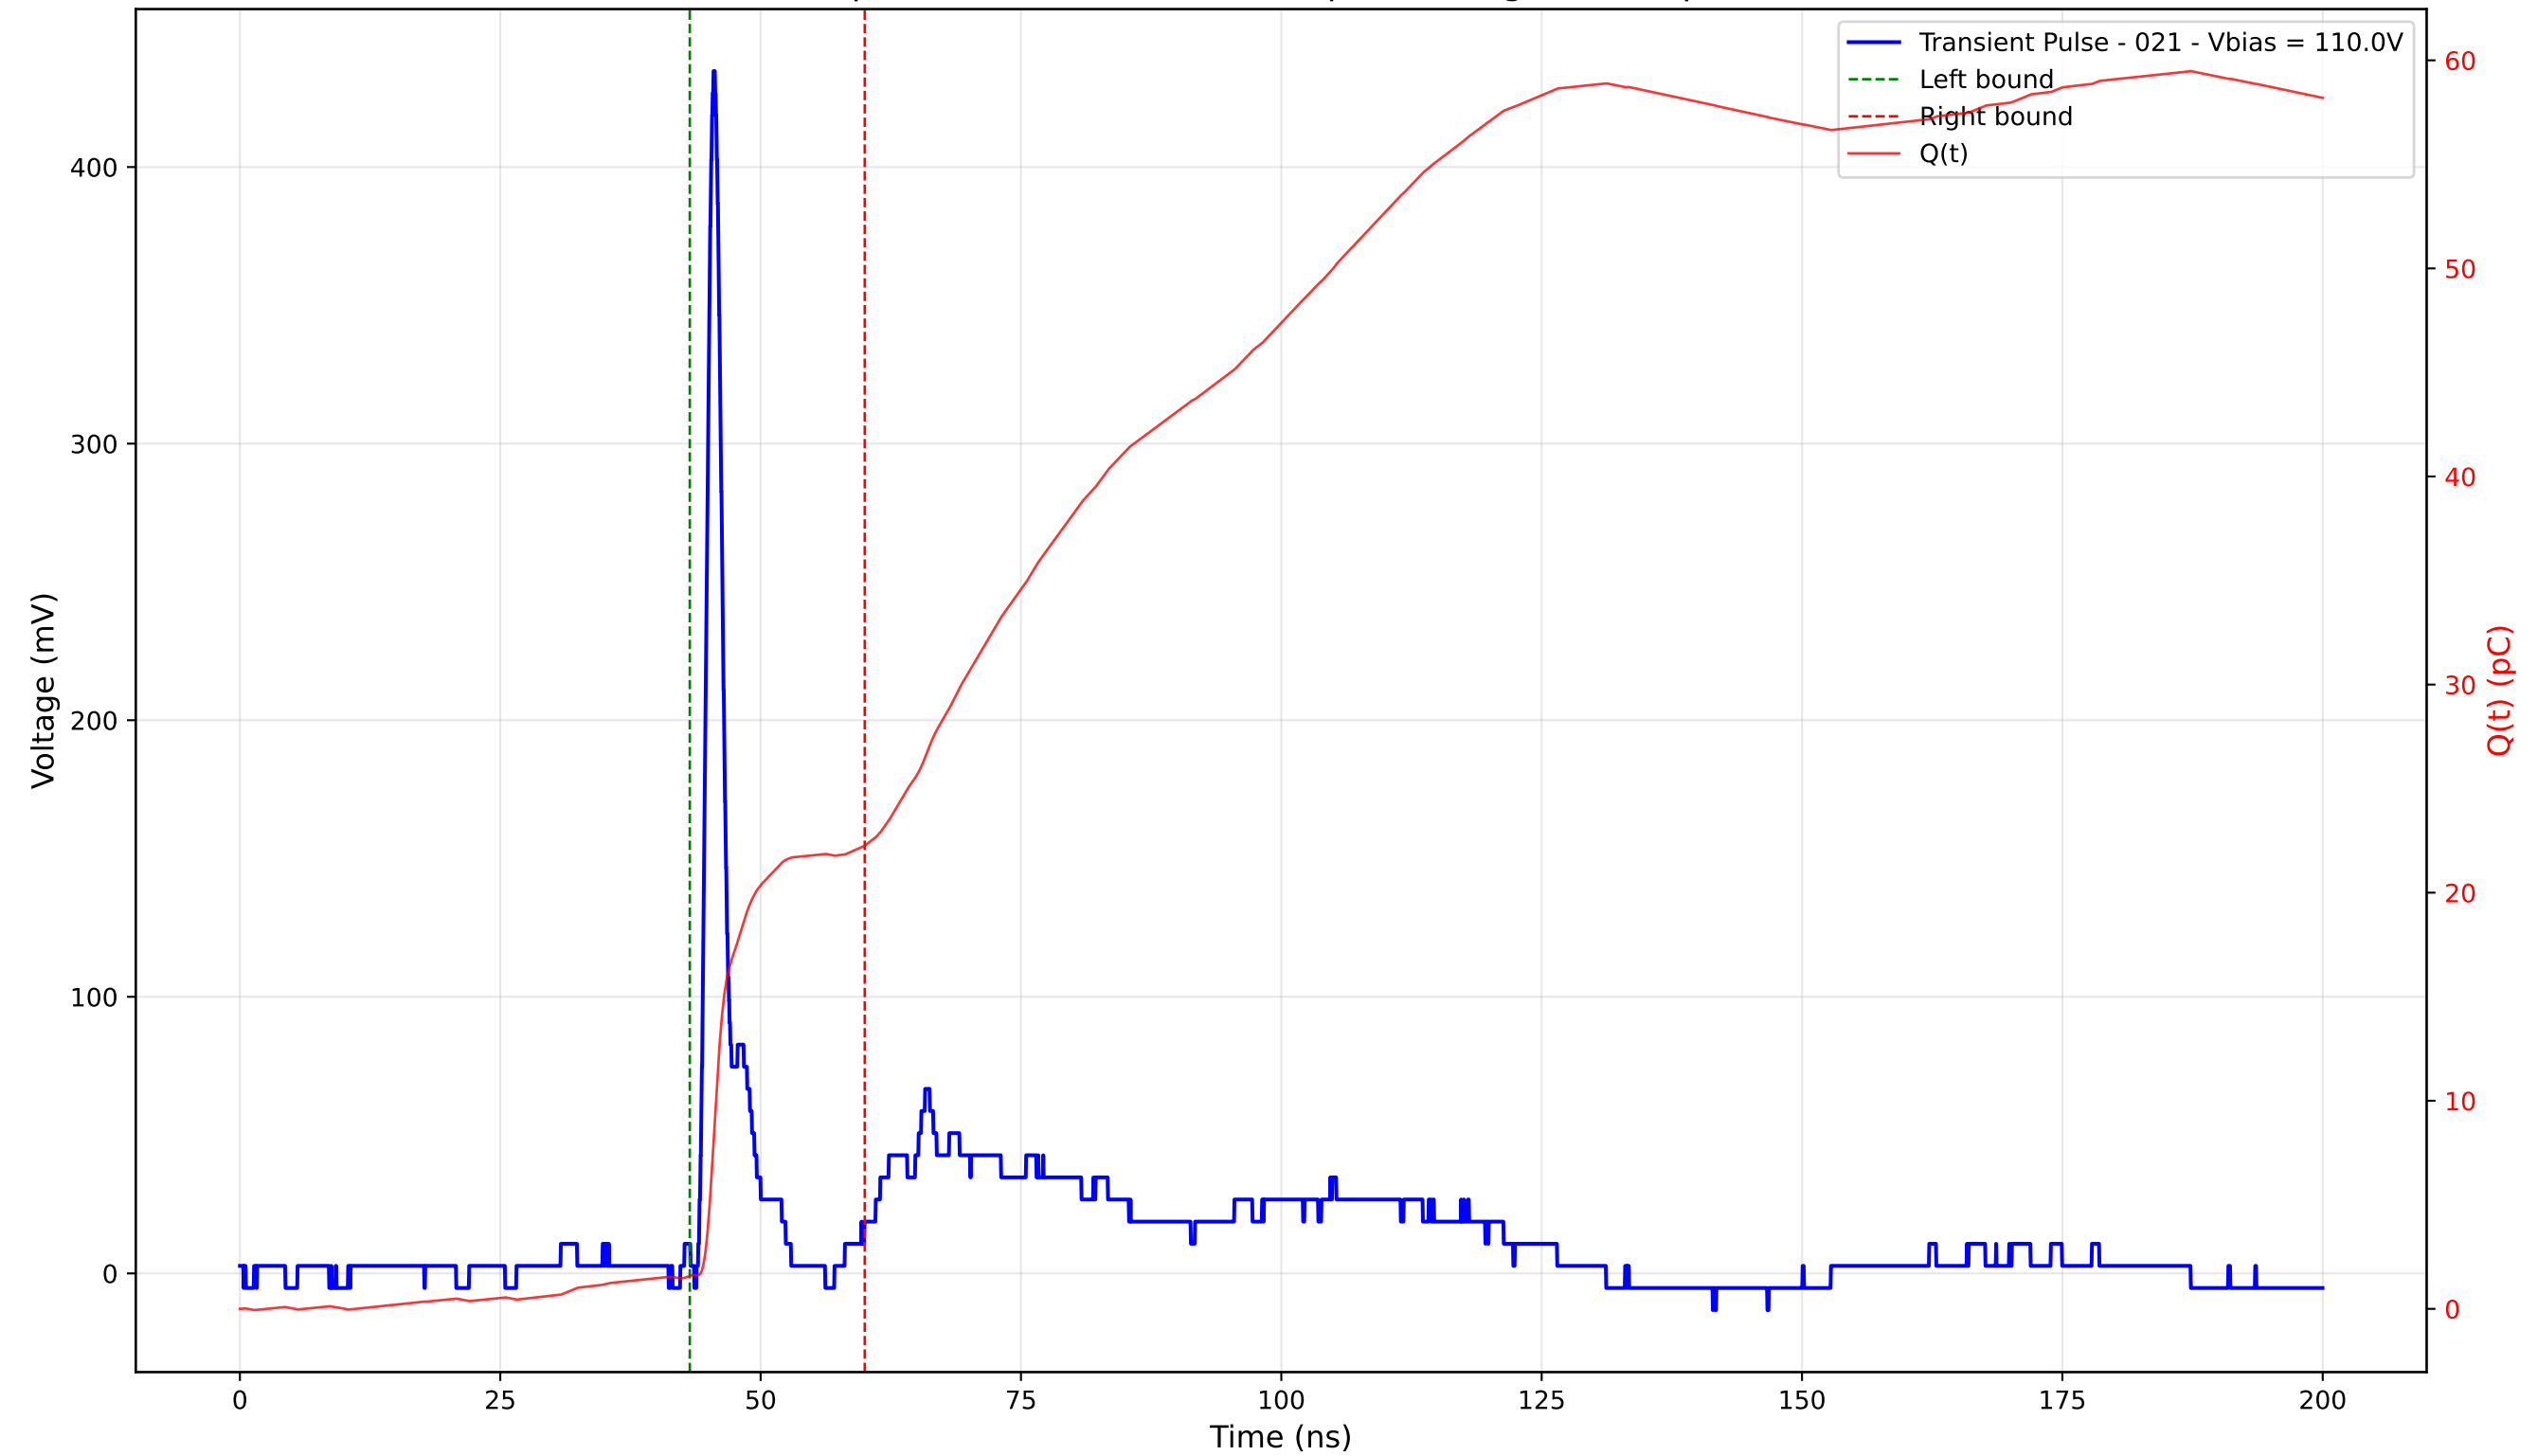


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 20.47 pC - Rise Time: 0.98 ns

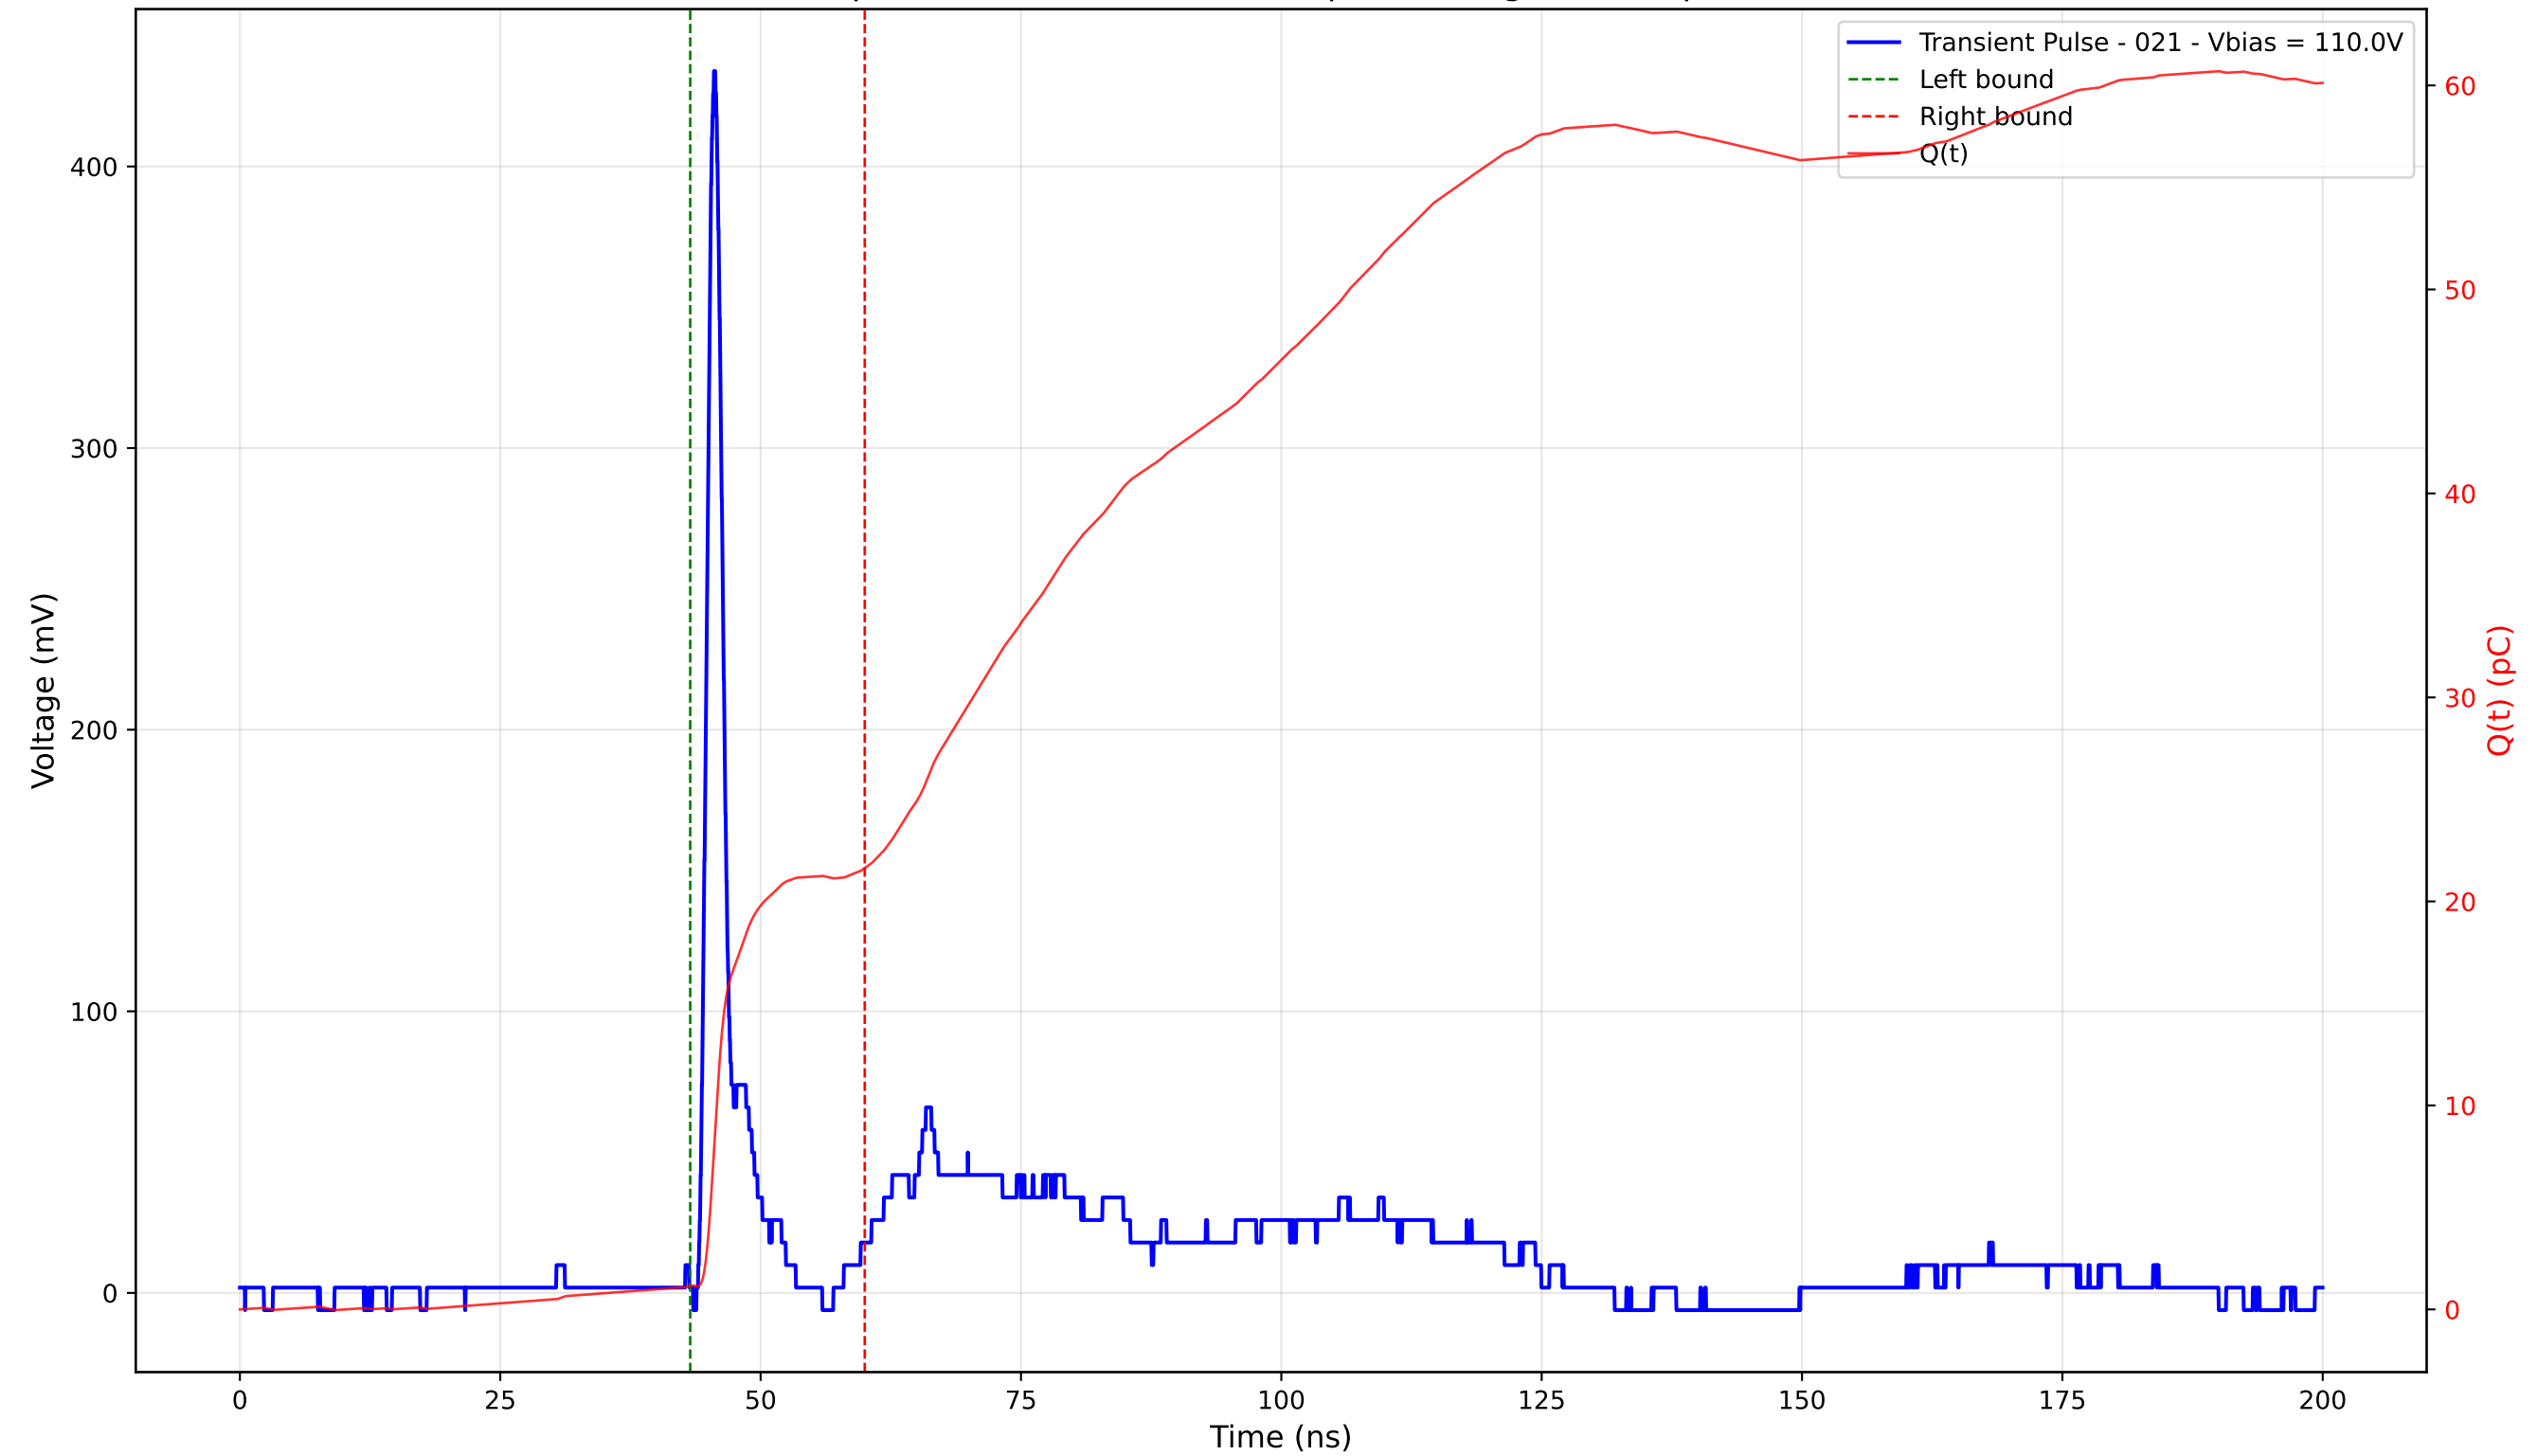


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 19.85 pC - Rise Time: 0.97 ns

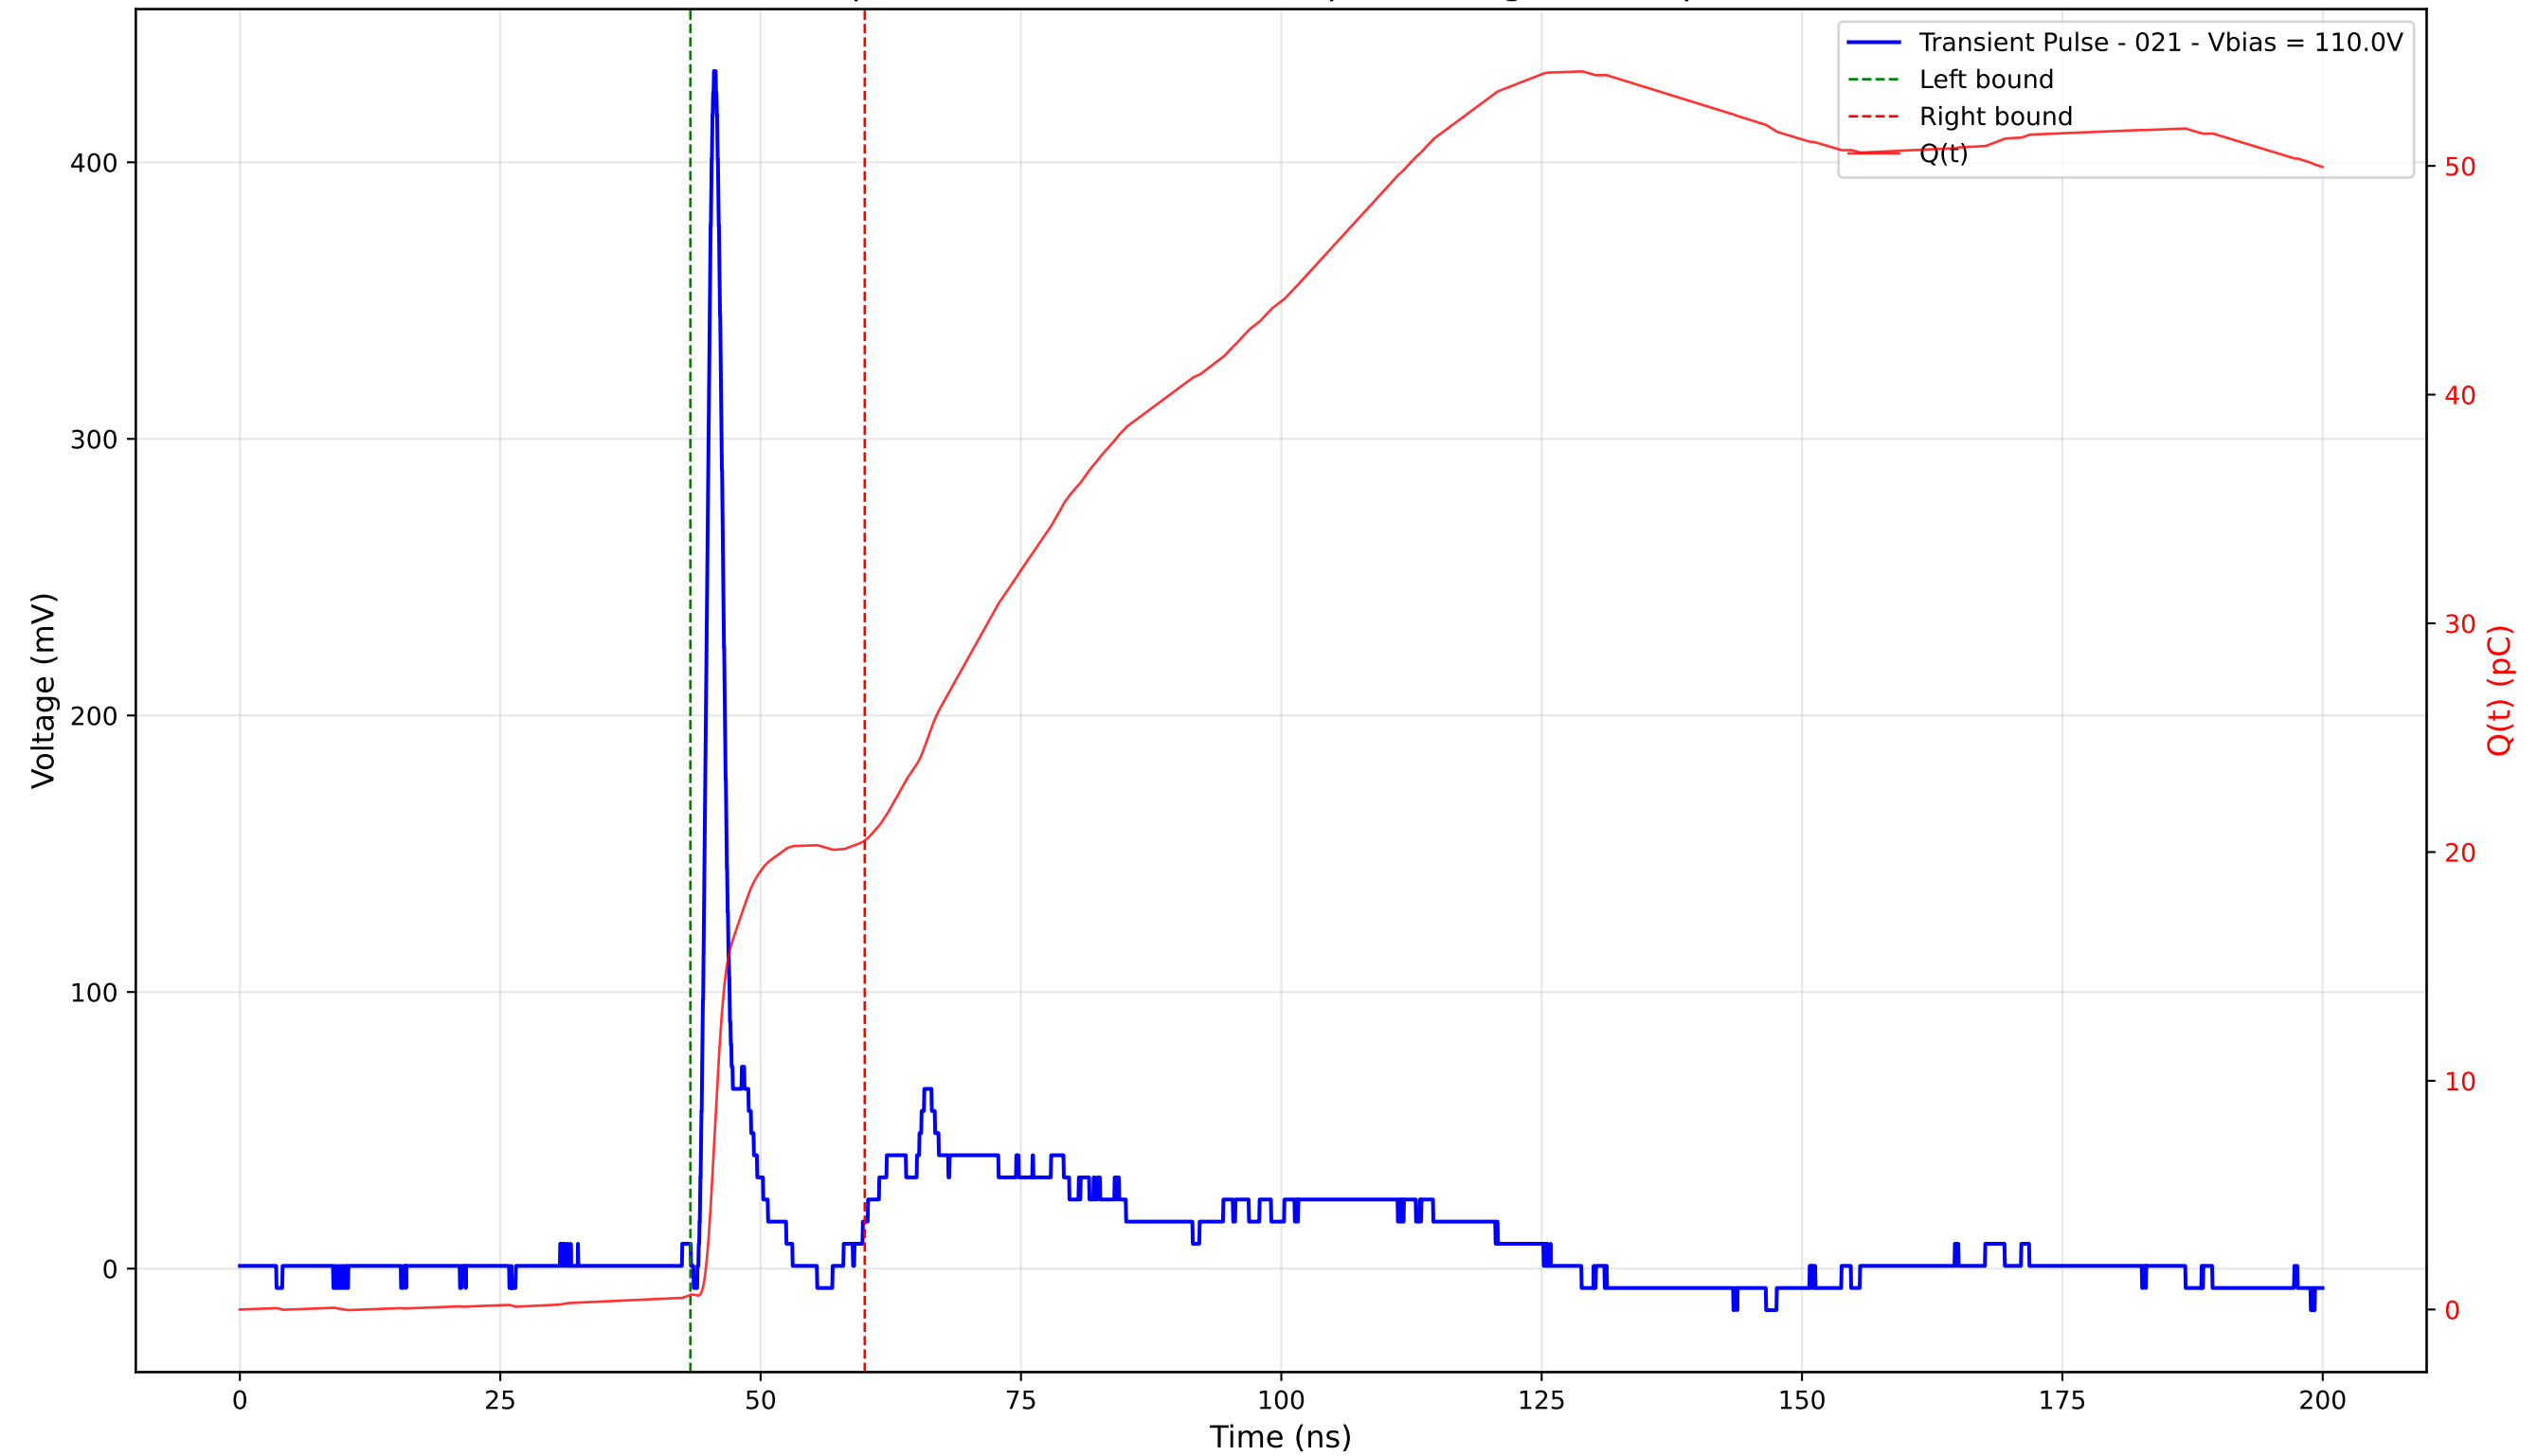


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 19.48 pC - Rise Time: 0.98 ns

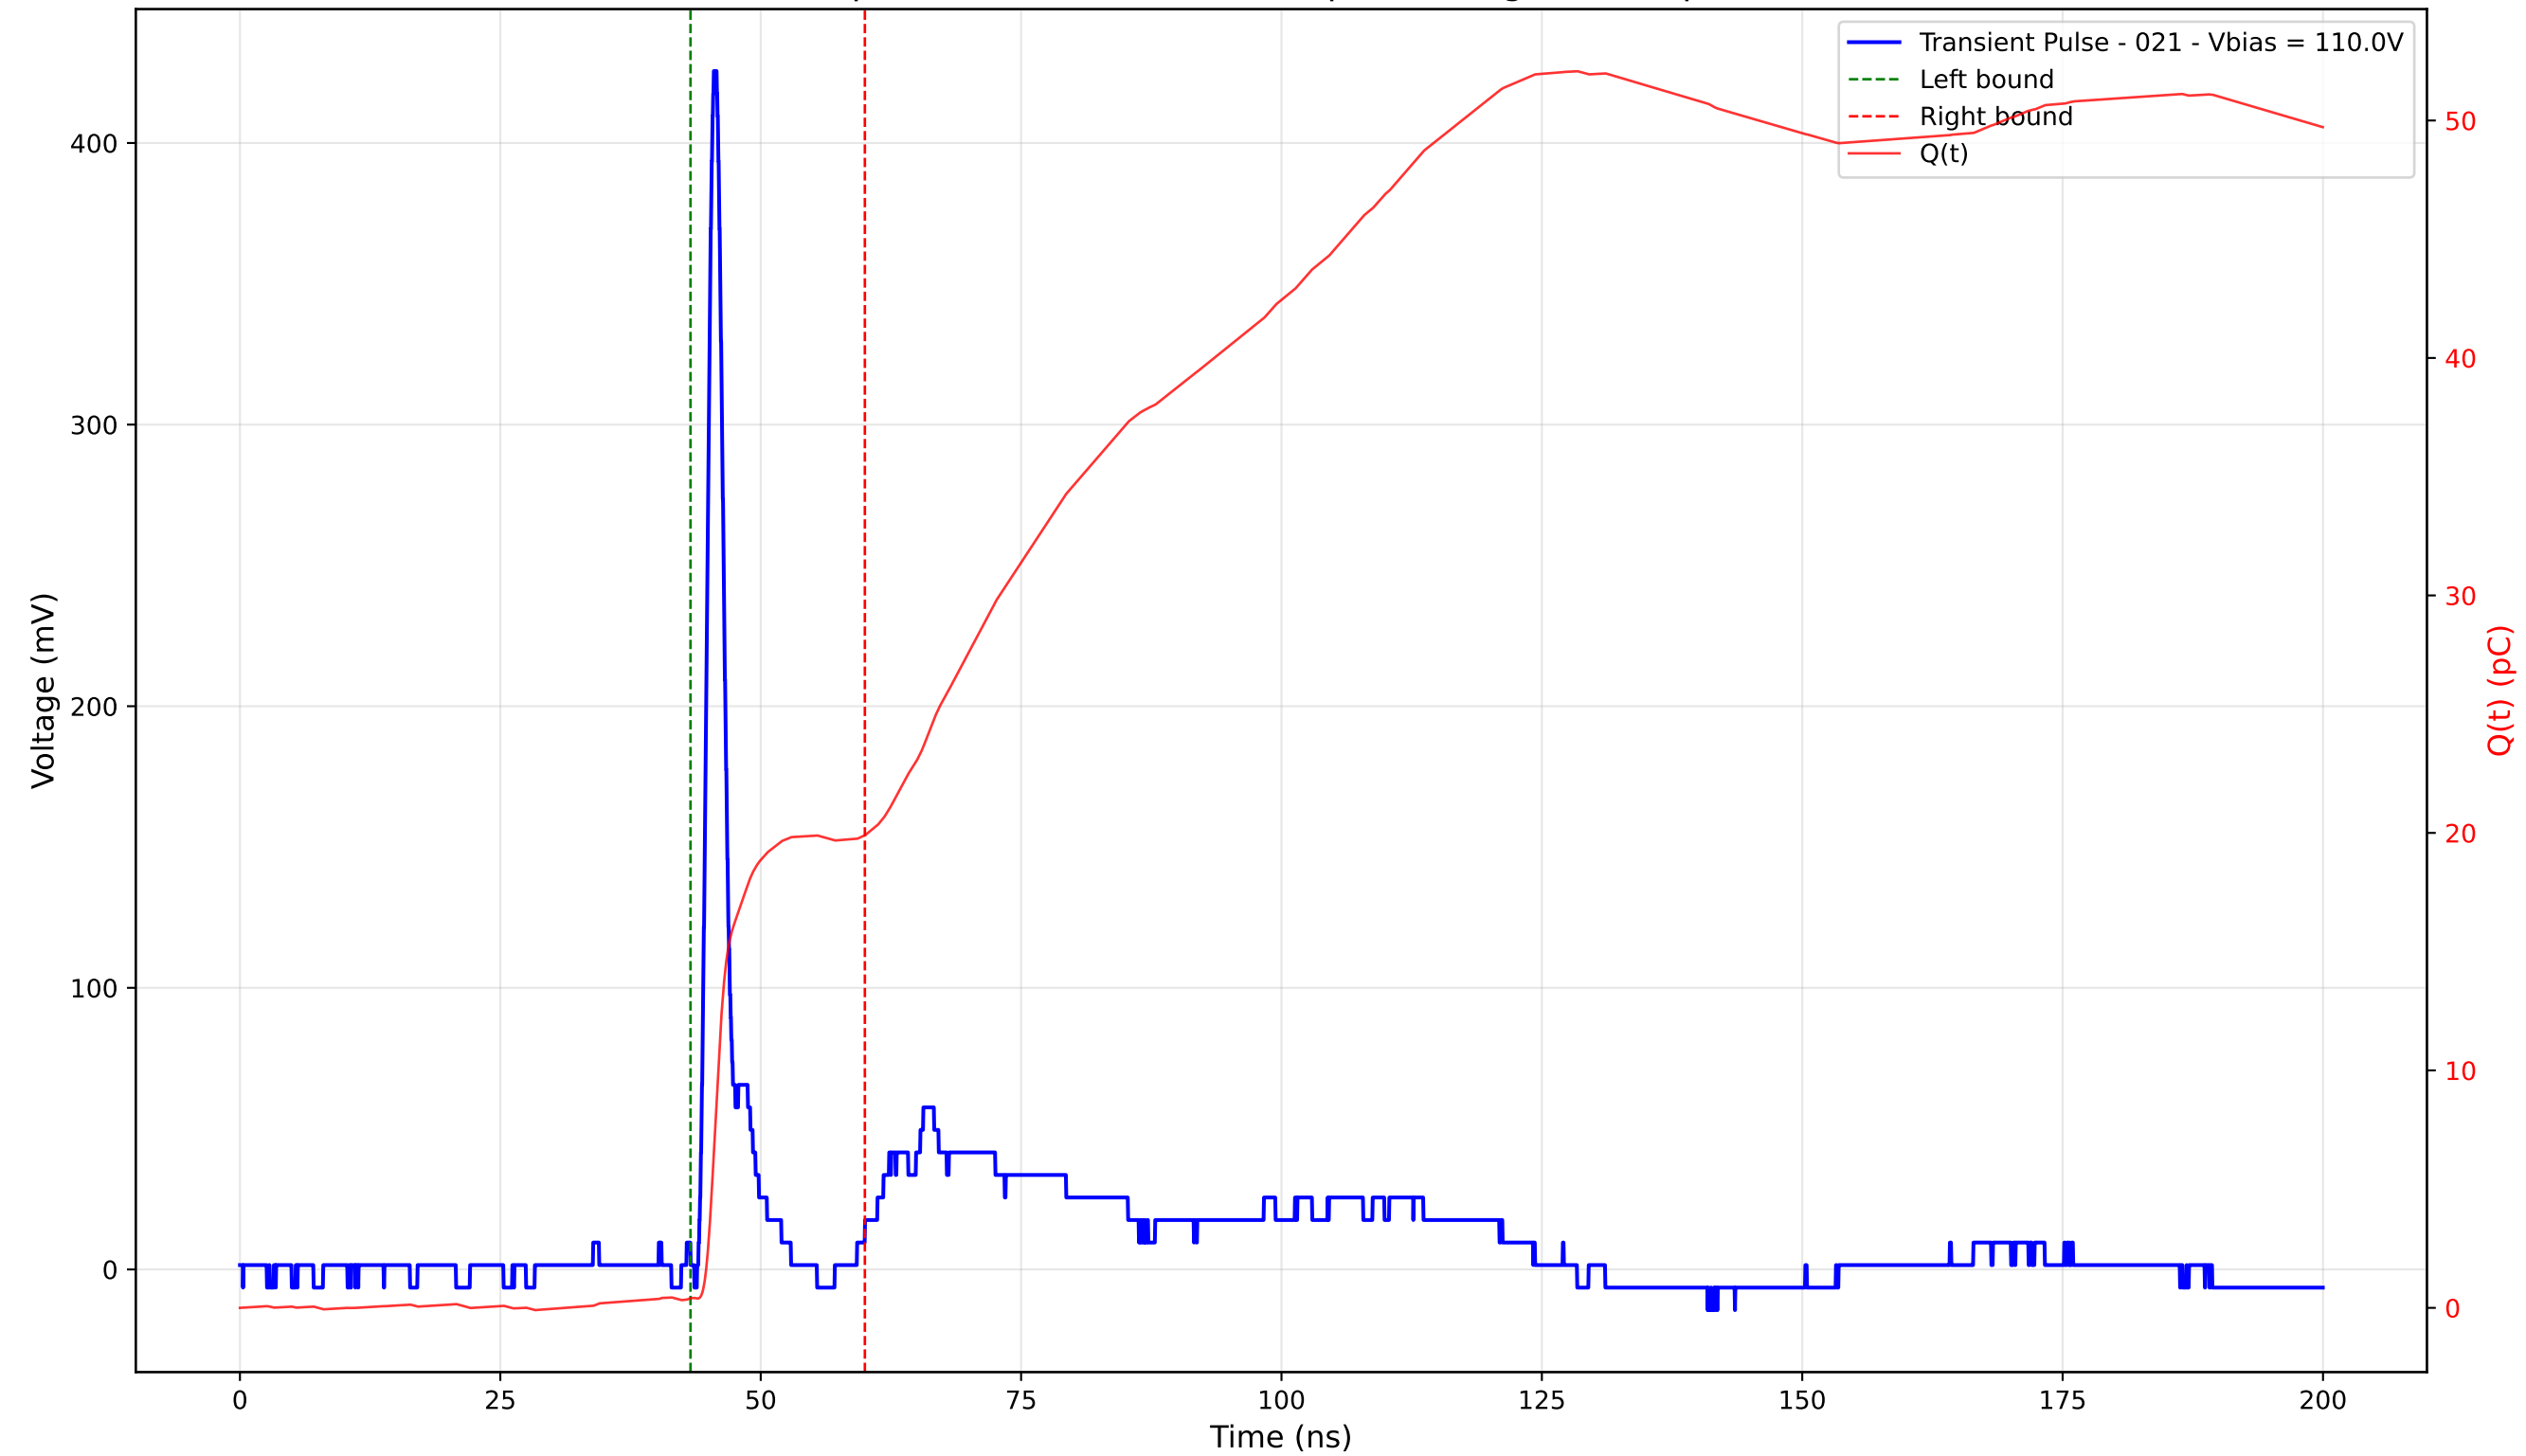


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 20.49 pC - Rise Time: 1.01 ns

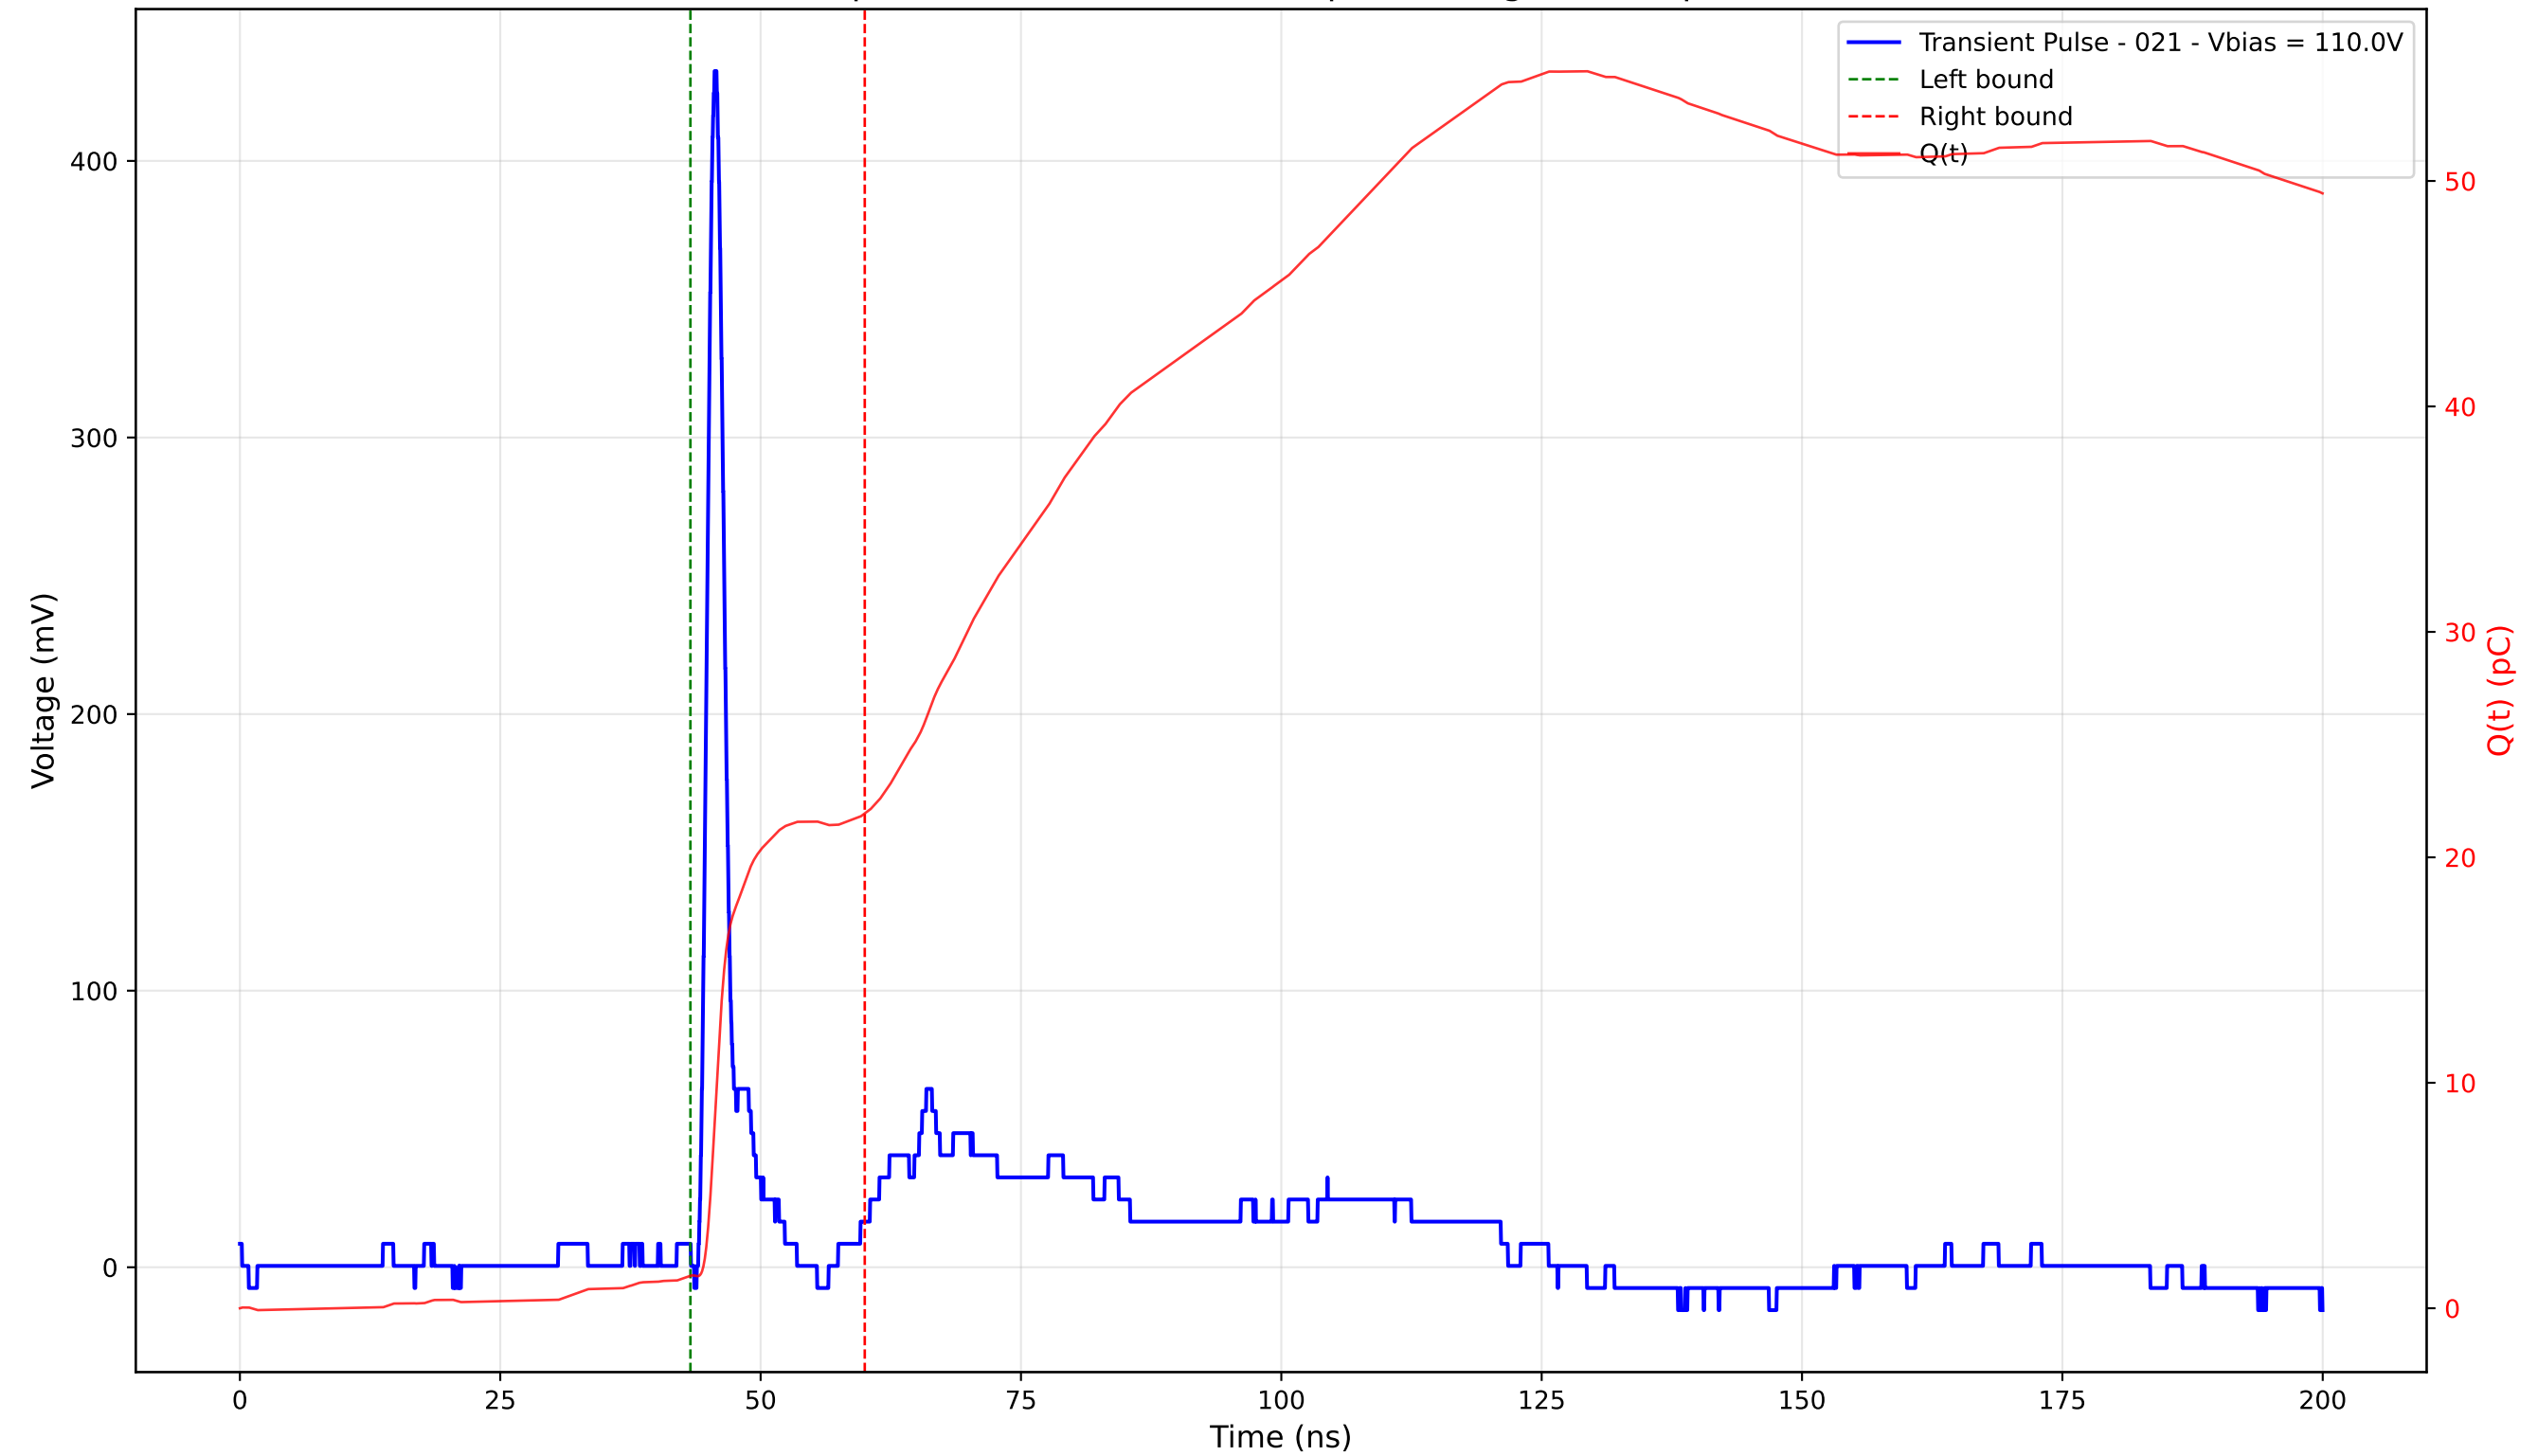


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 20.76 pC - Rise Time: 1.04 ns

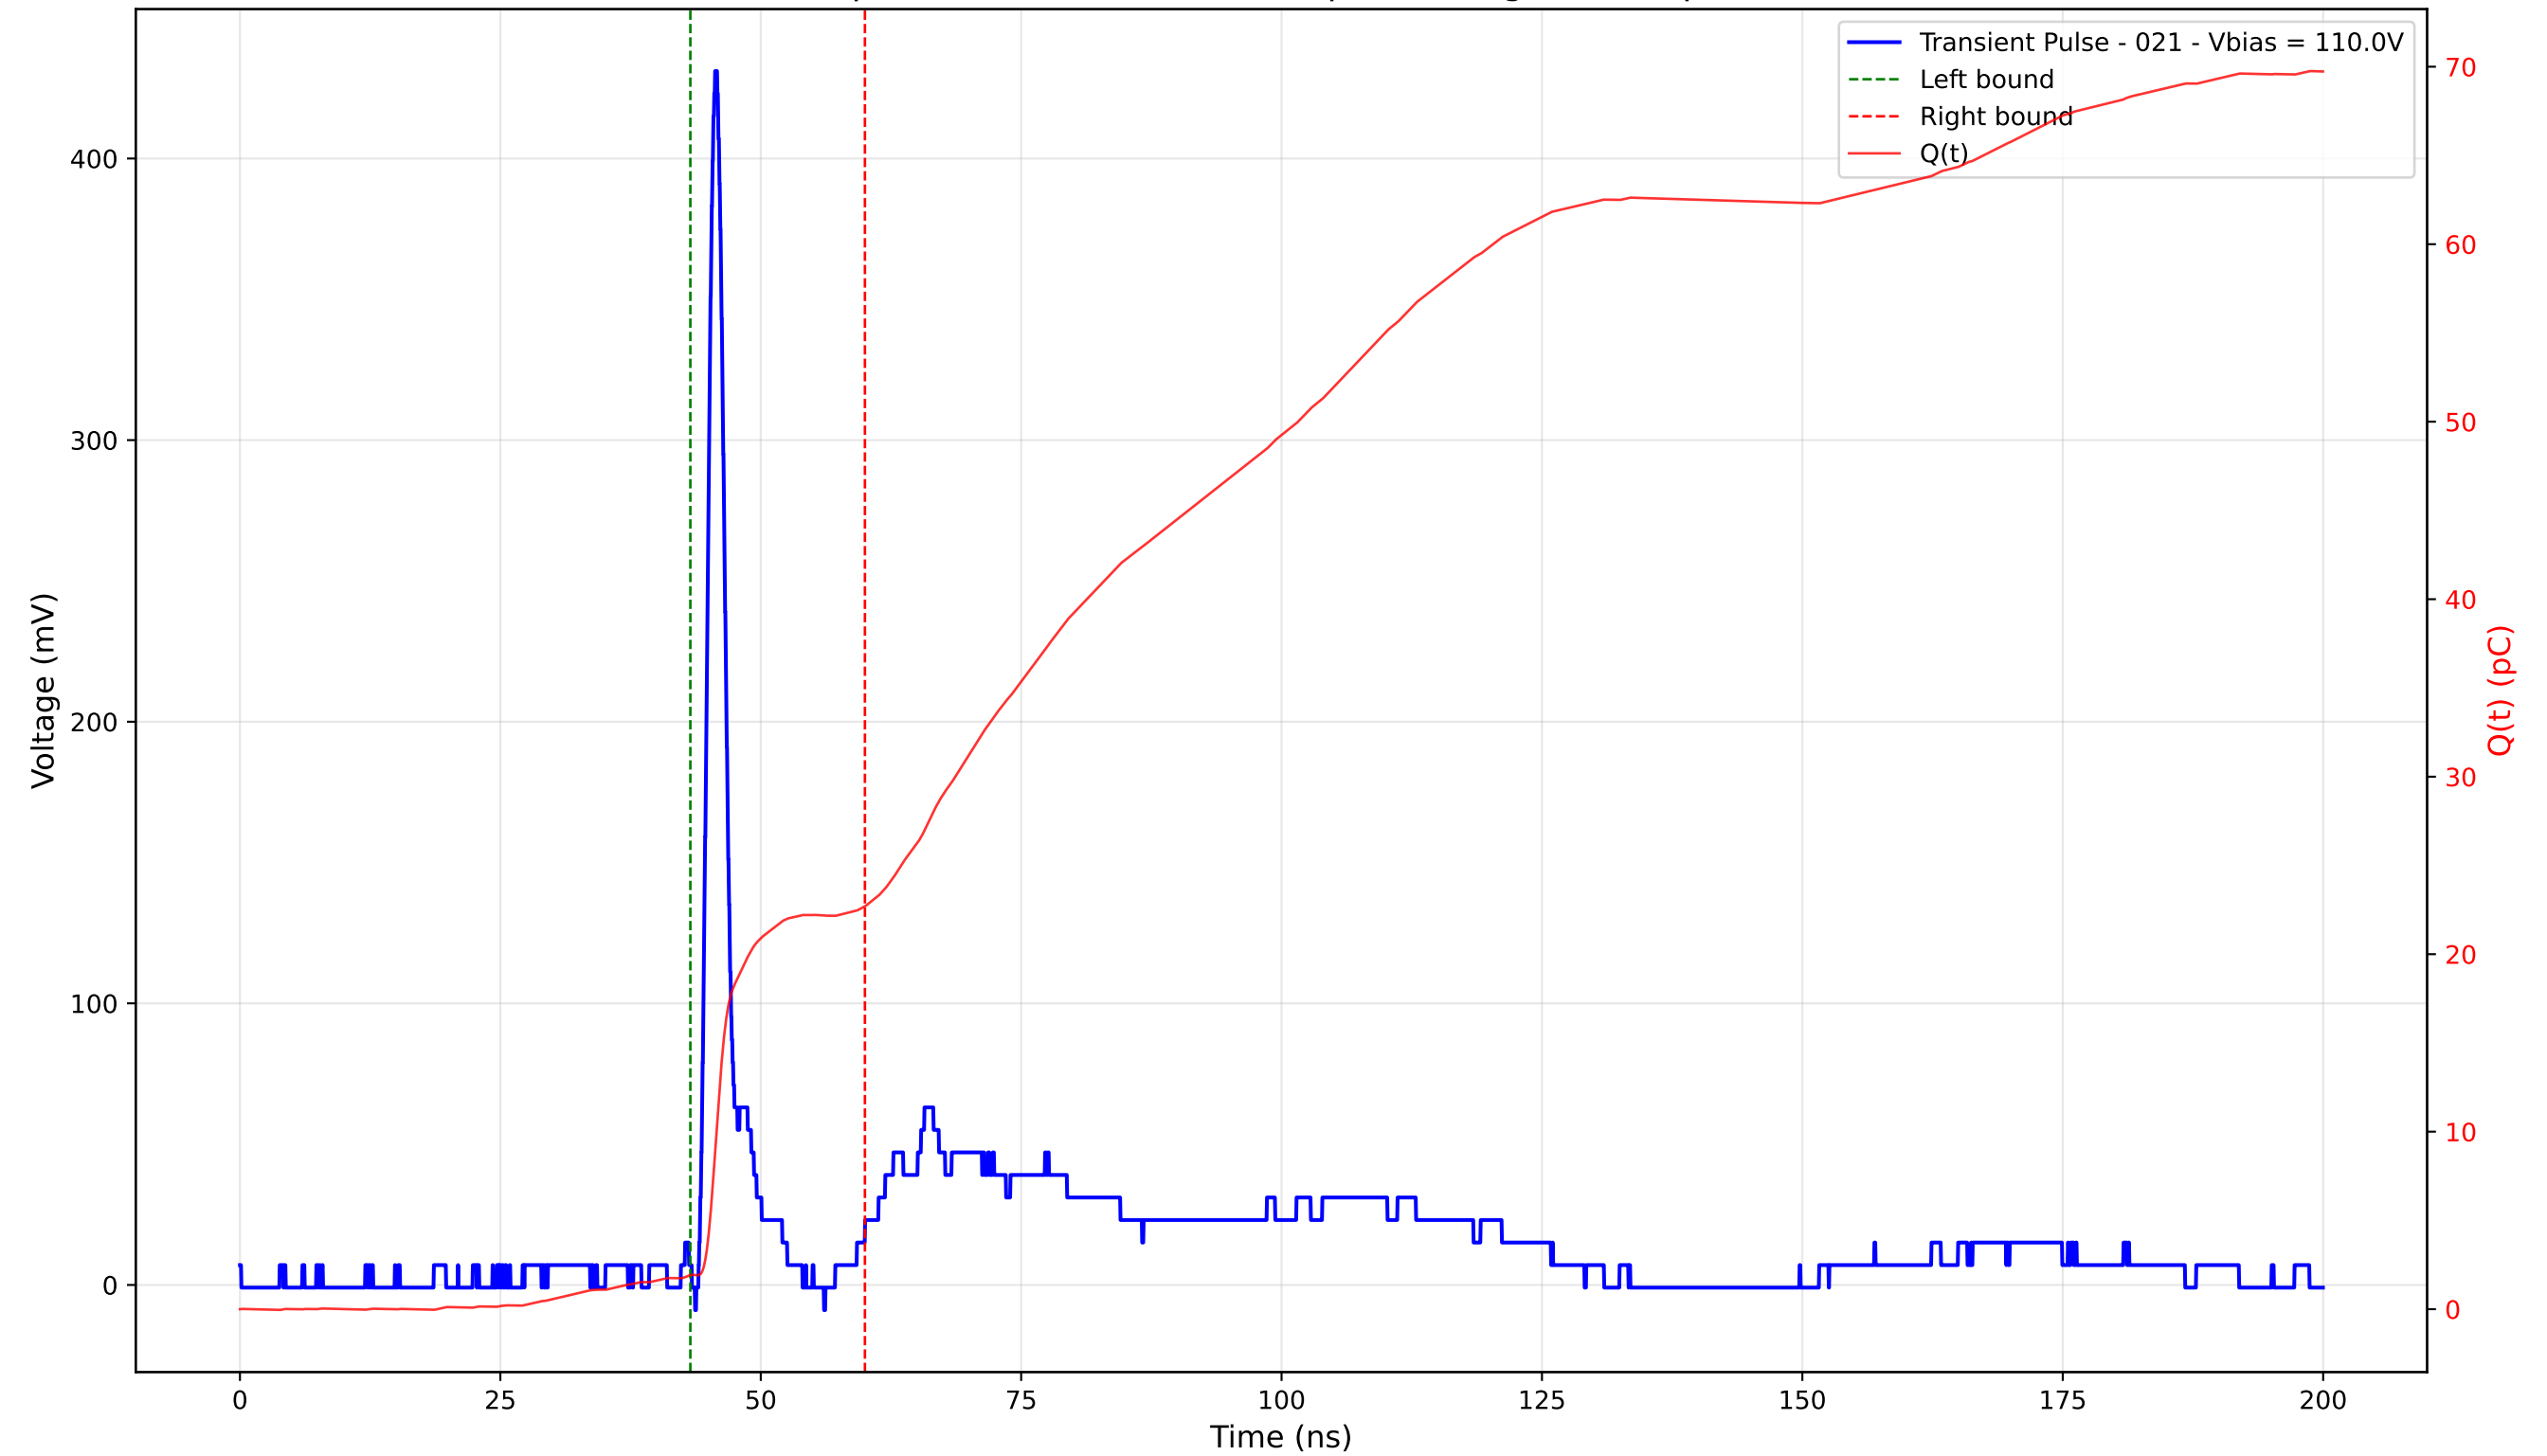


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 20.58 pC - Rise Time: 1.08 ns

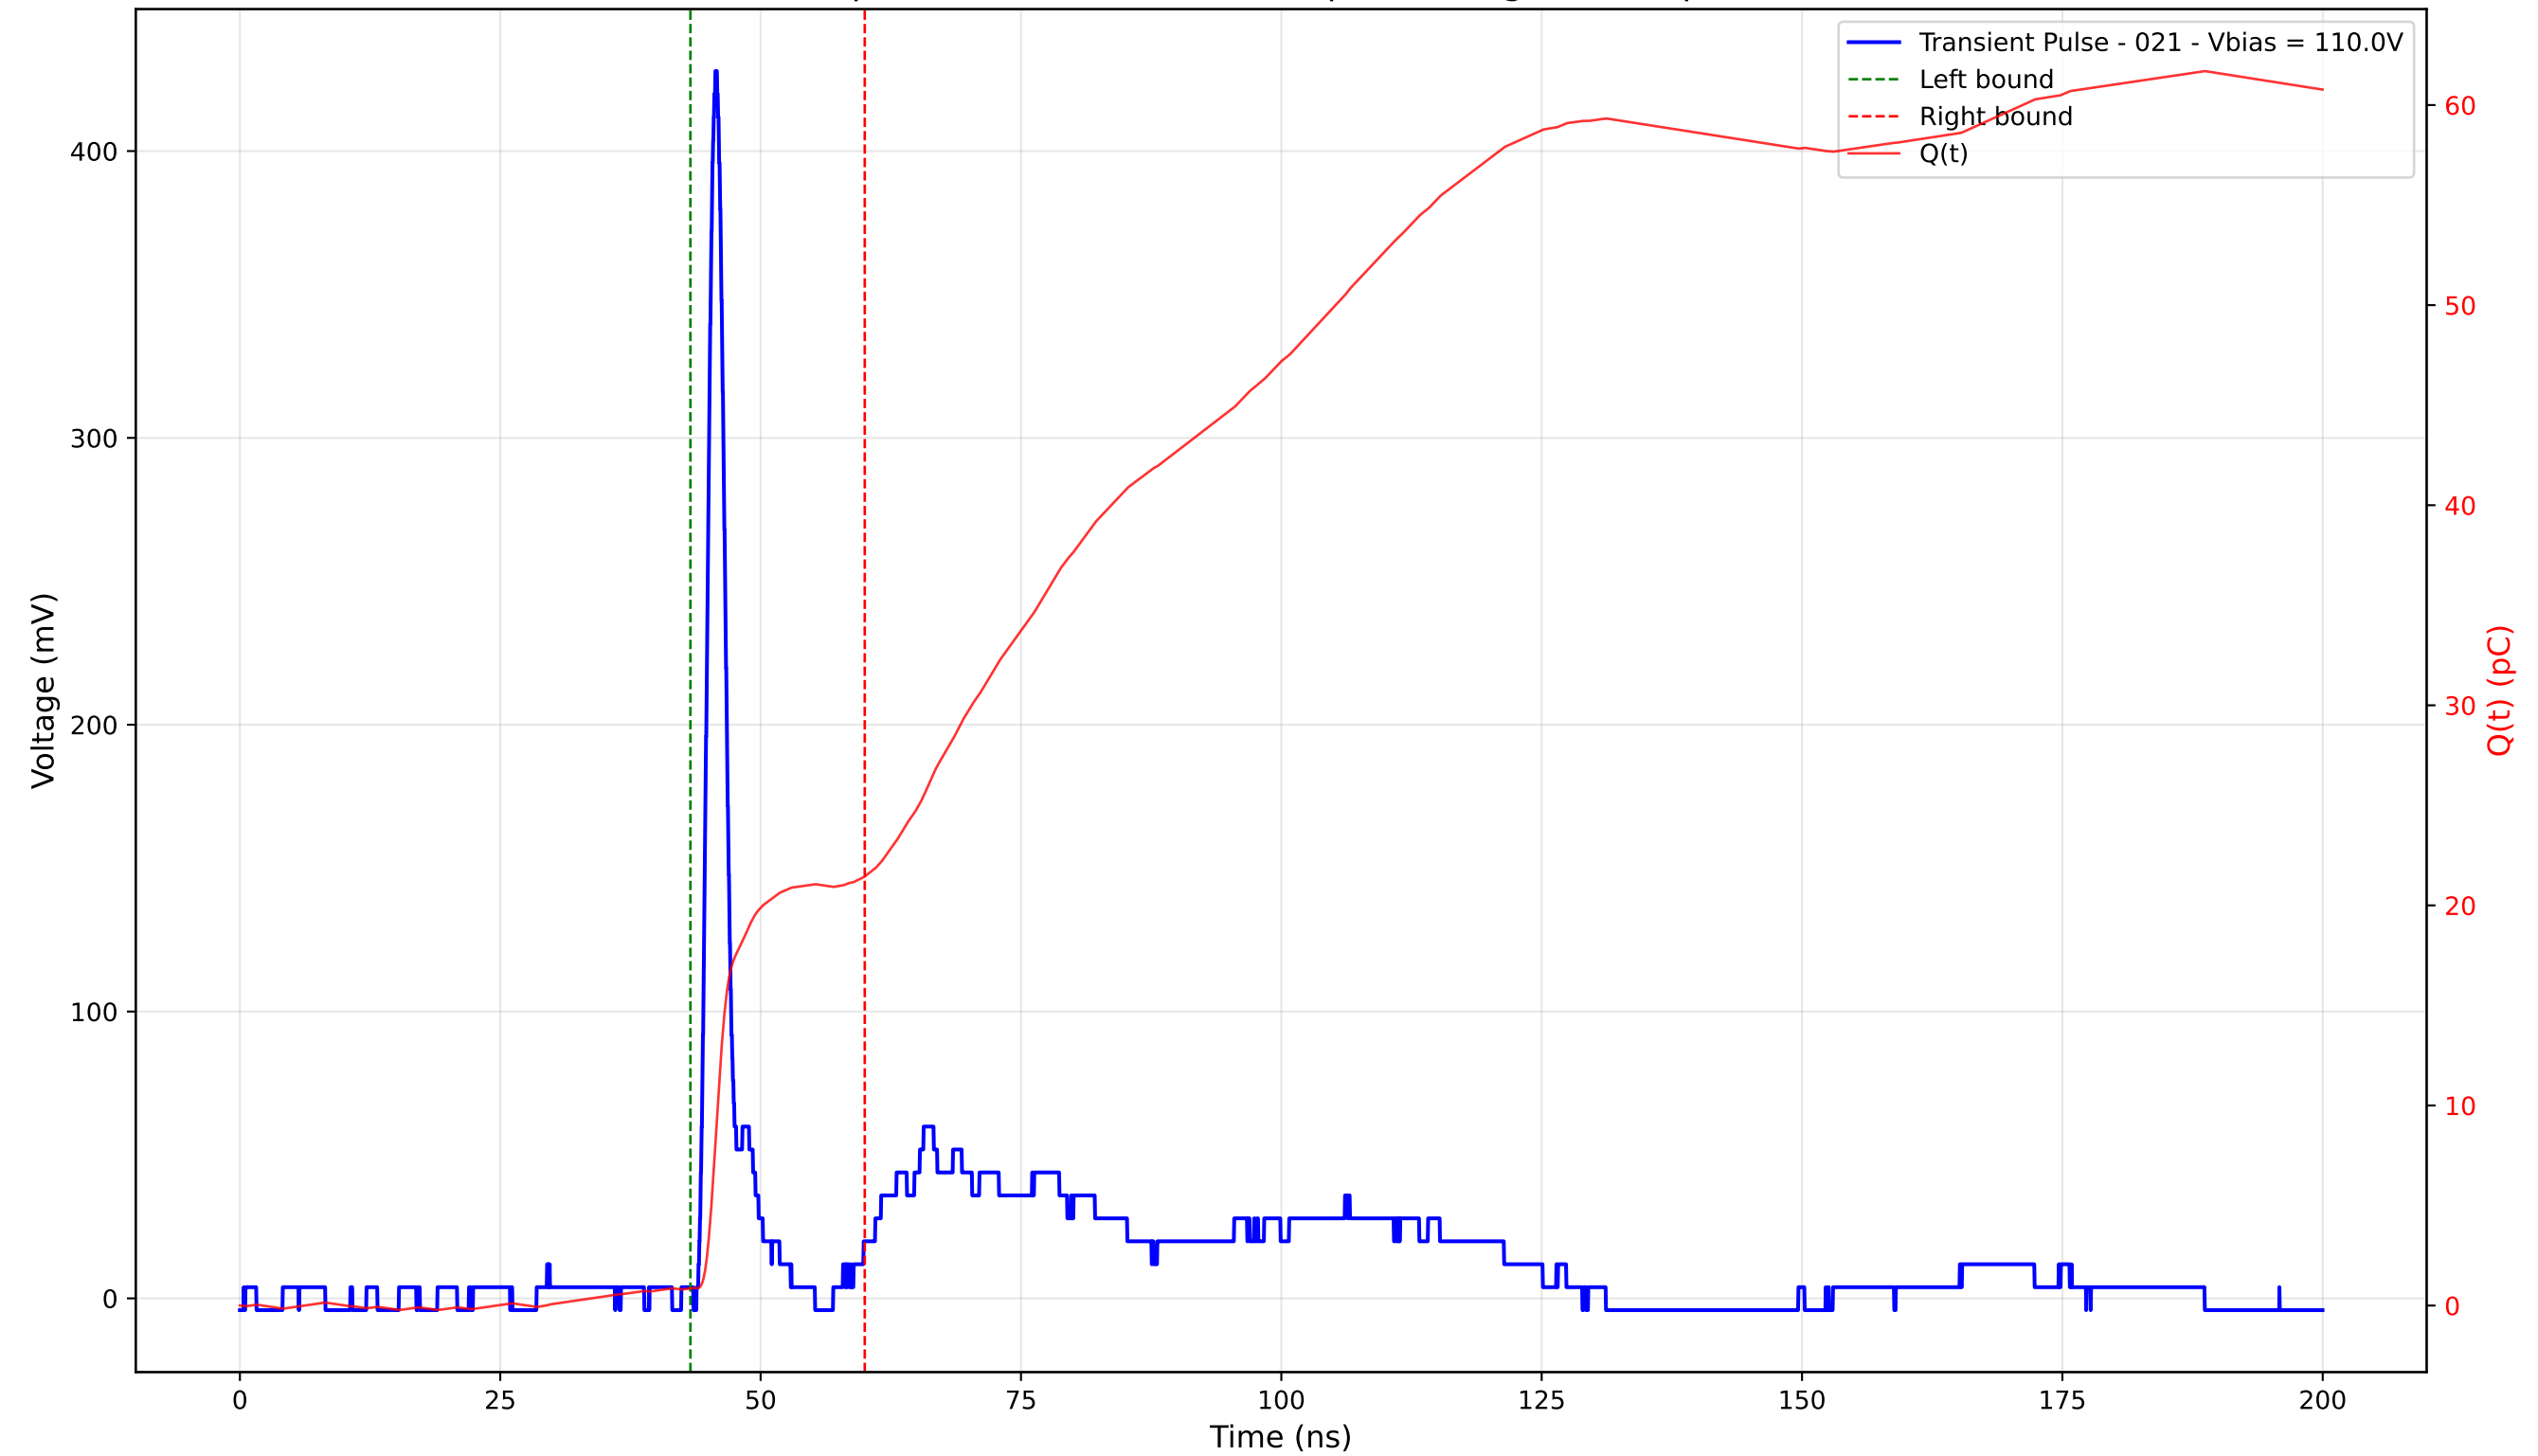


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 19.70 pC - Rise Time: 1.10 ns

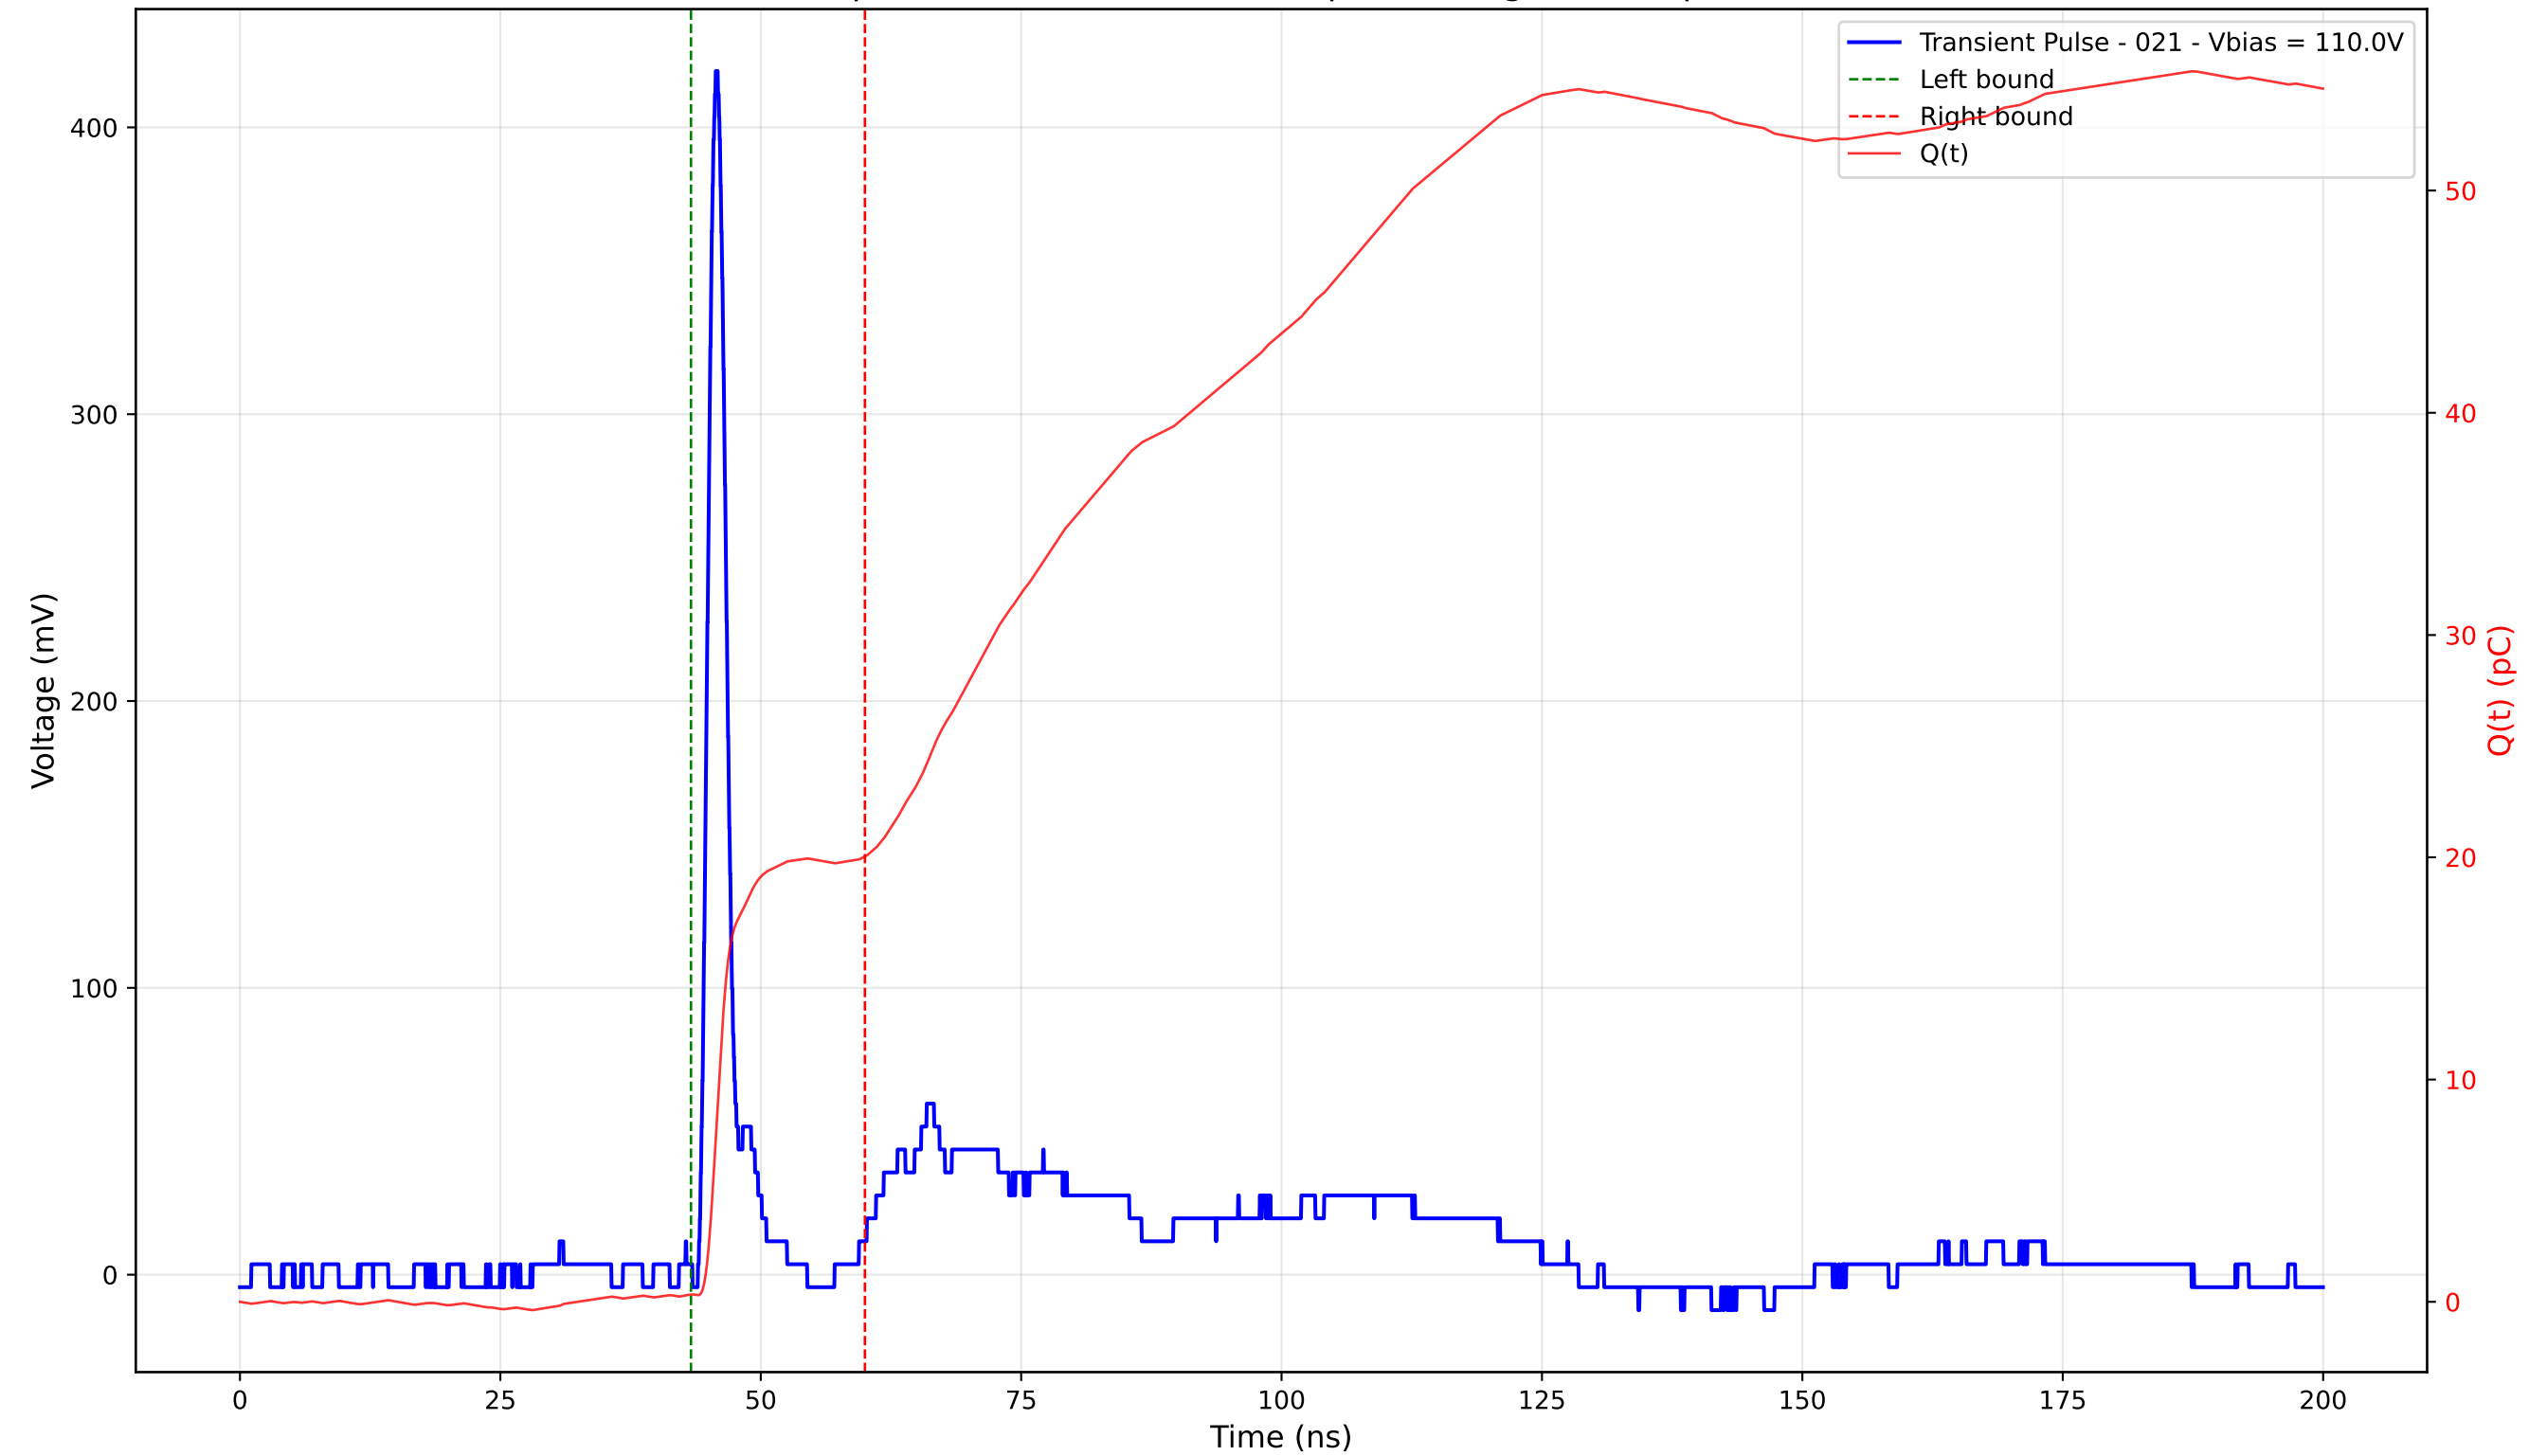


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 19.82 pC - Rise Time: 1.09 ns

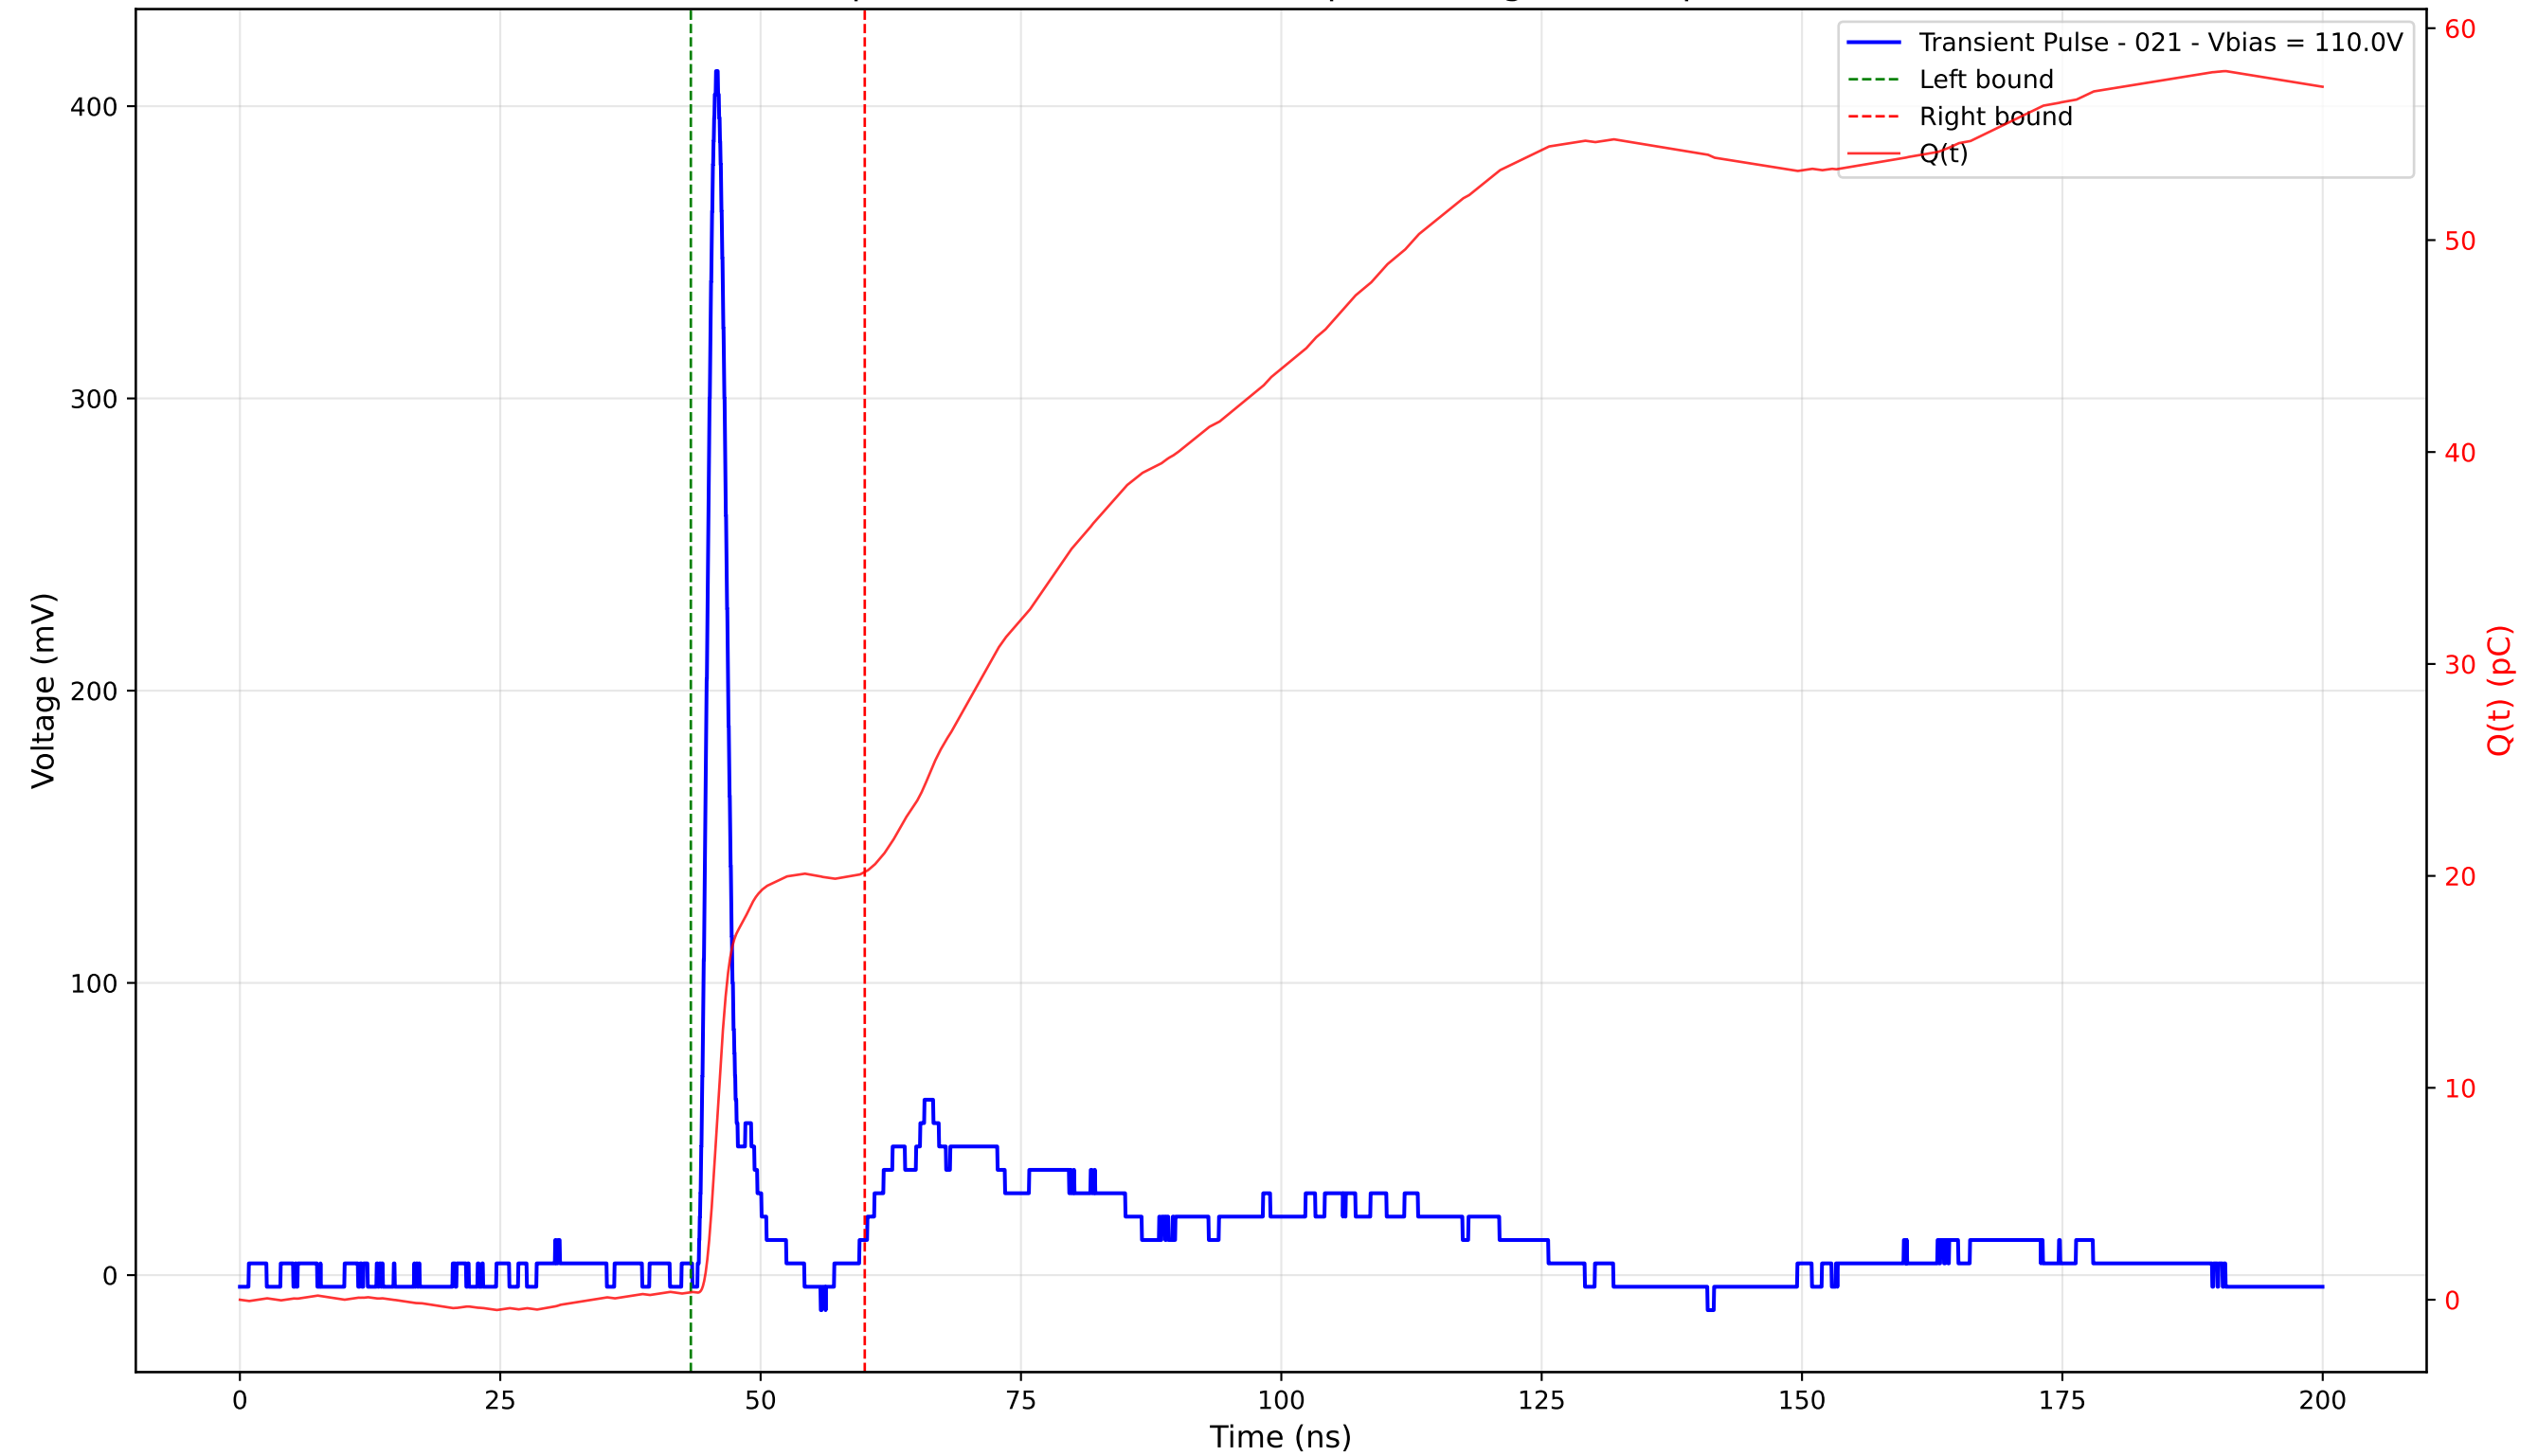


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 20.14 pC - Rise Time: 1.14 ns

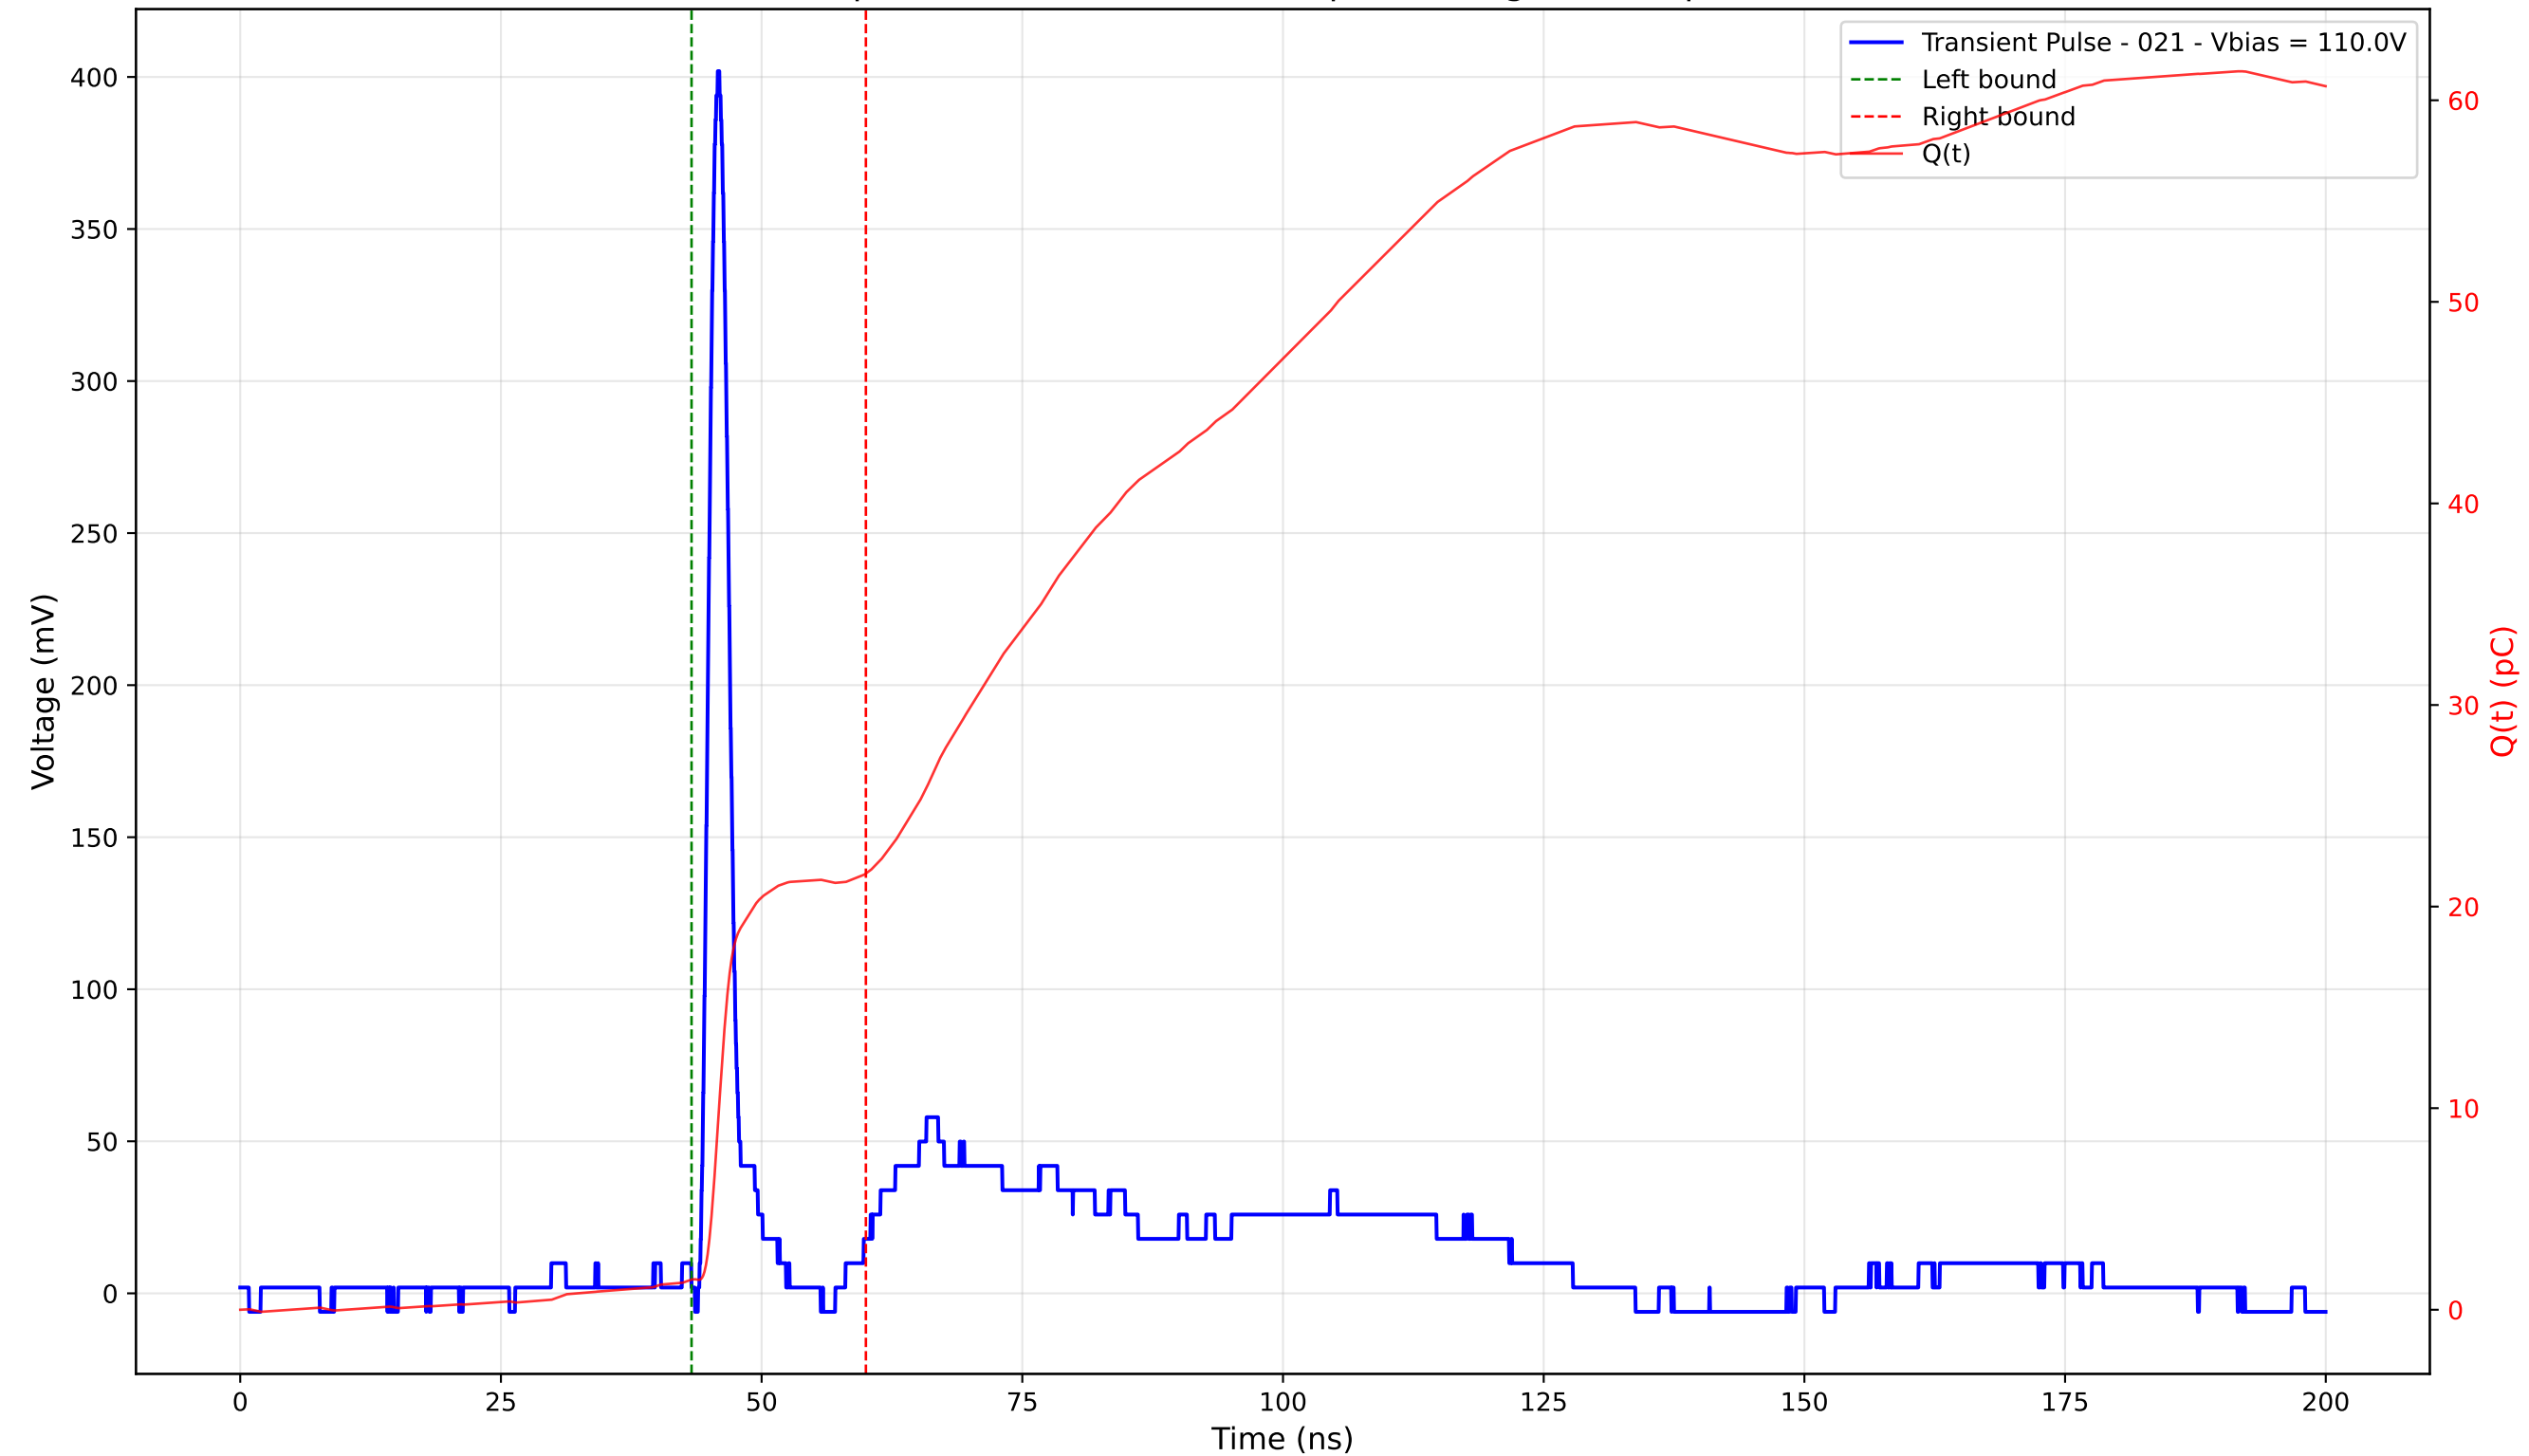


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 20.67 pC - Rise Time: 1.18 ns

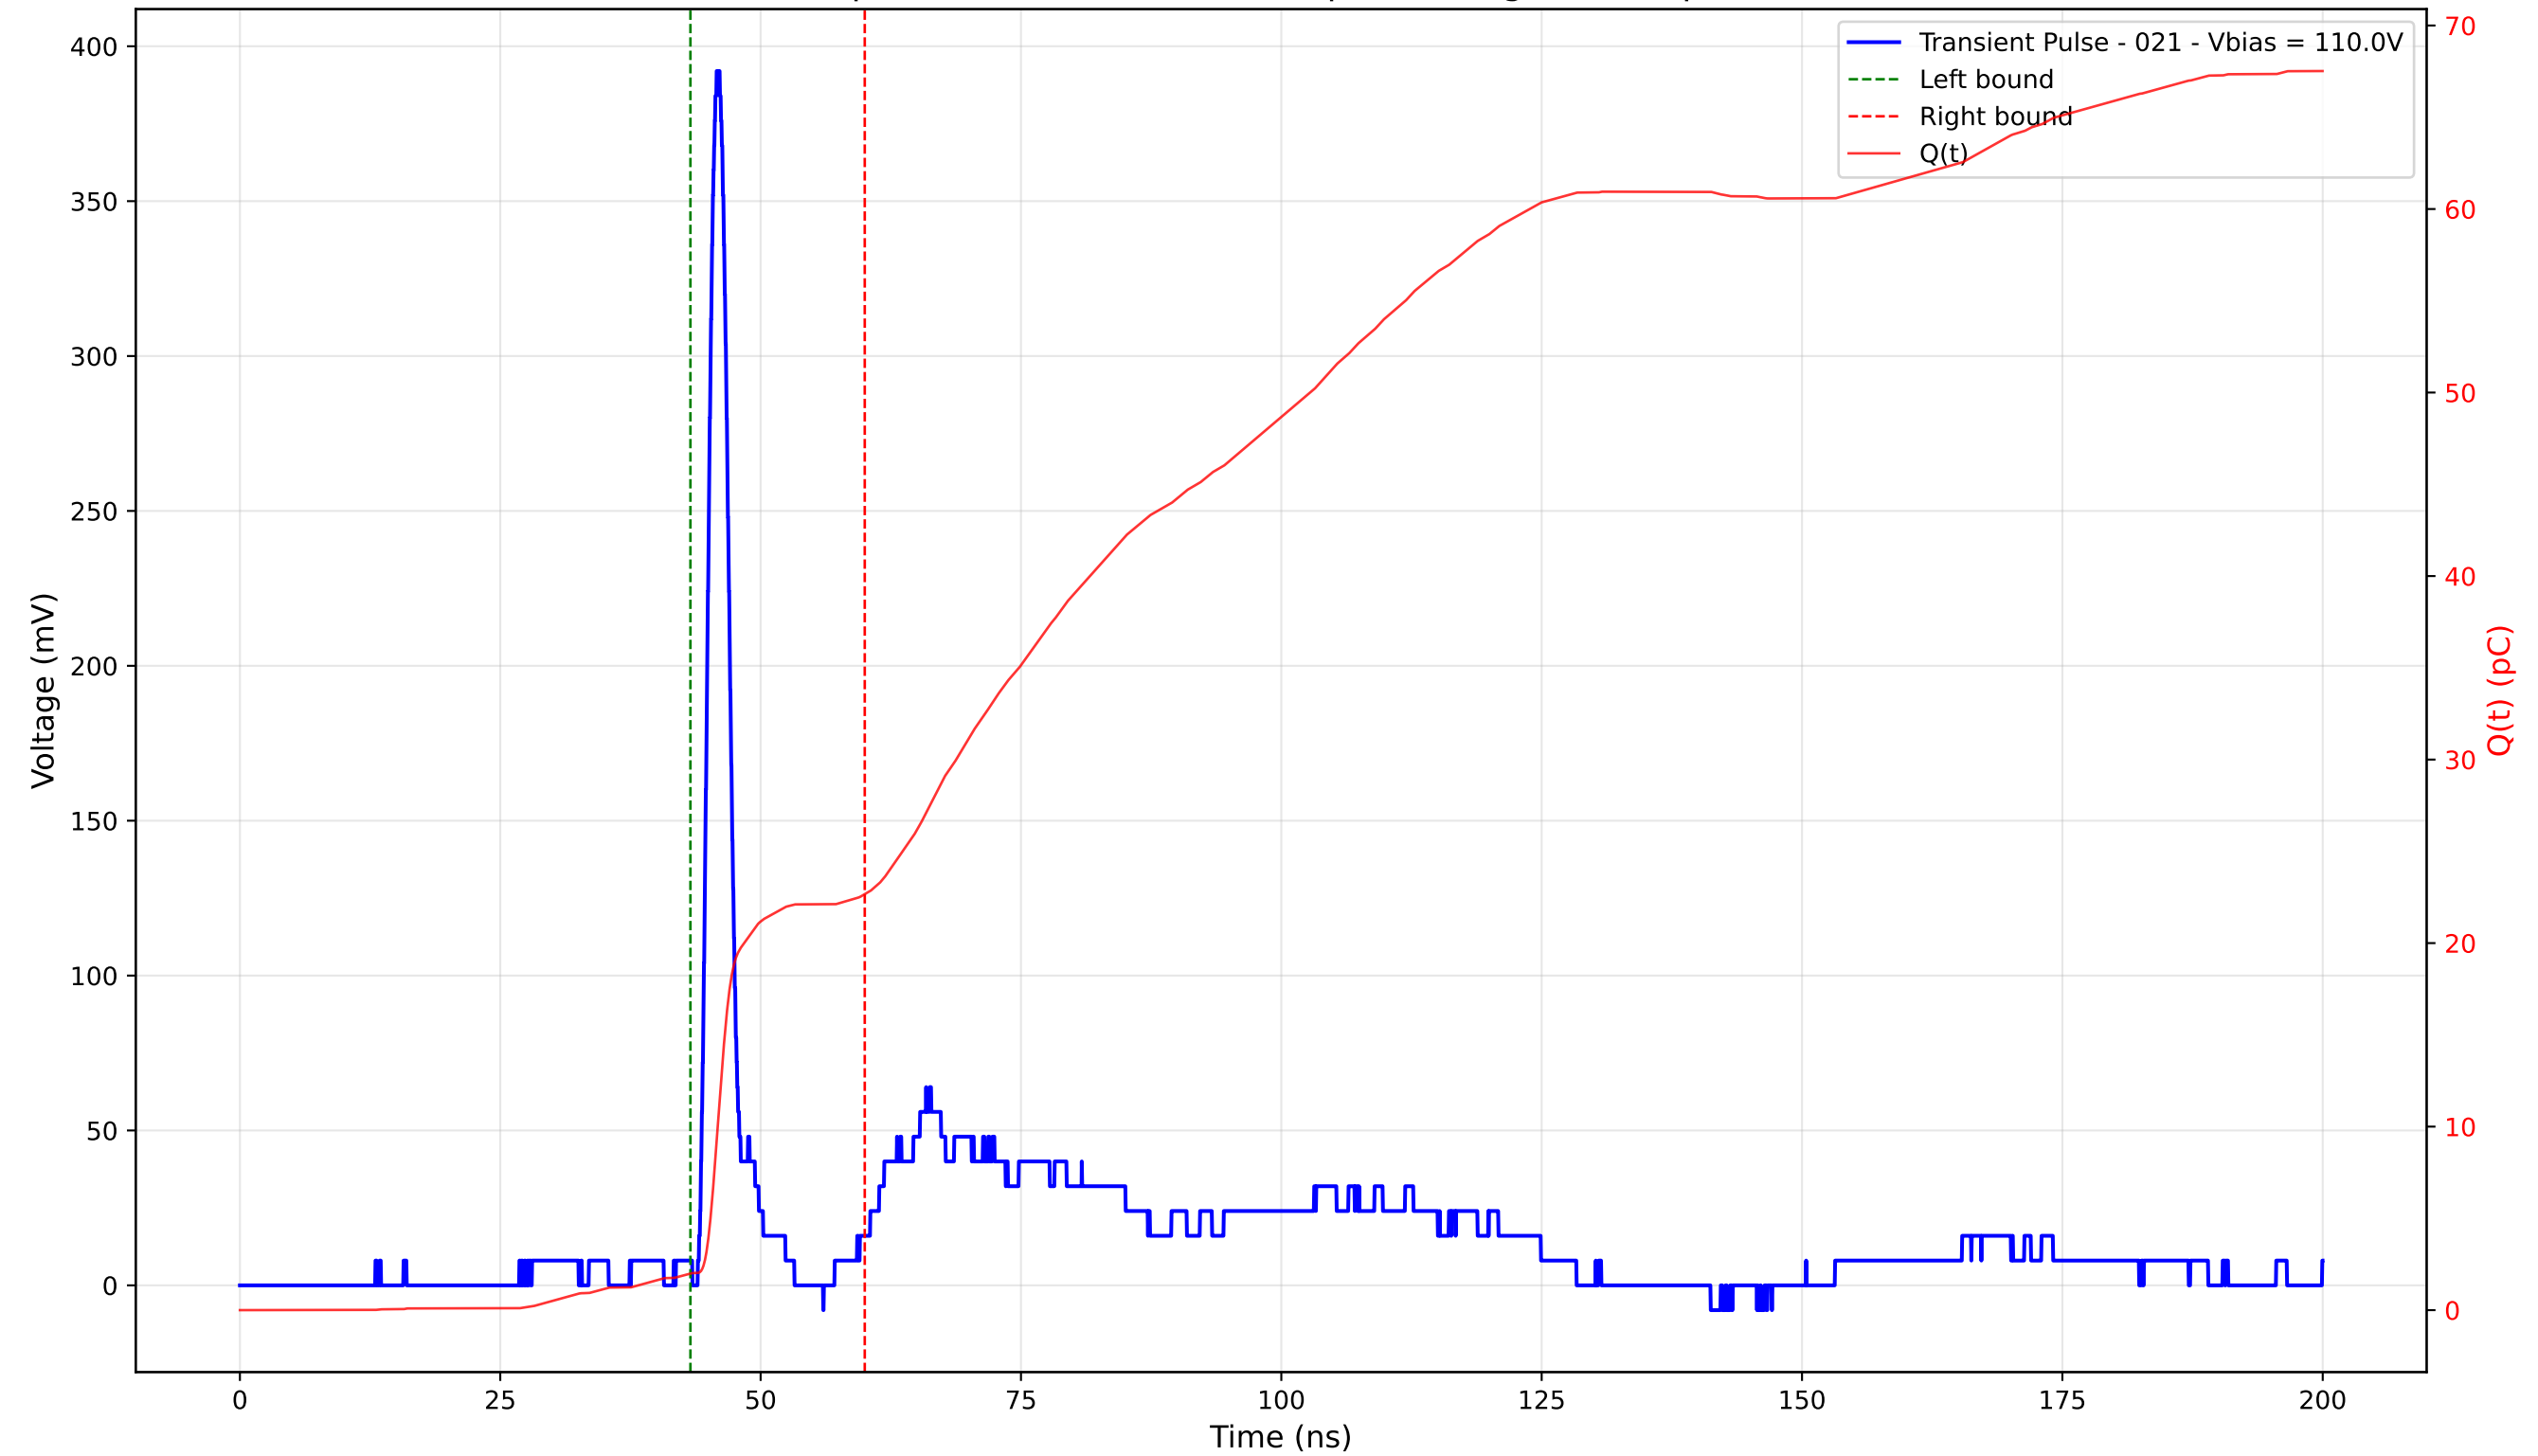


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 19.71 pC - Rise Time: 1.20 ns

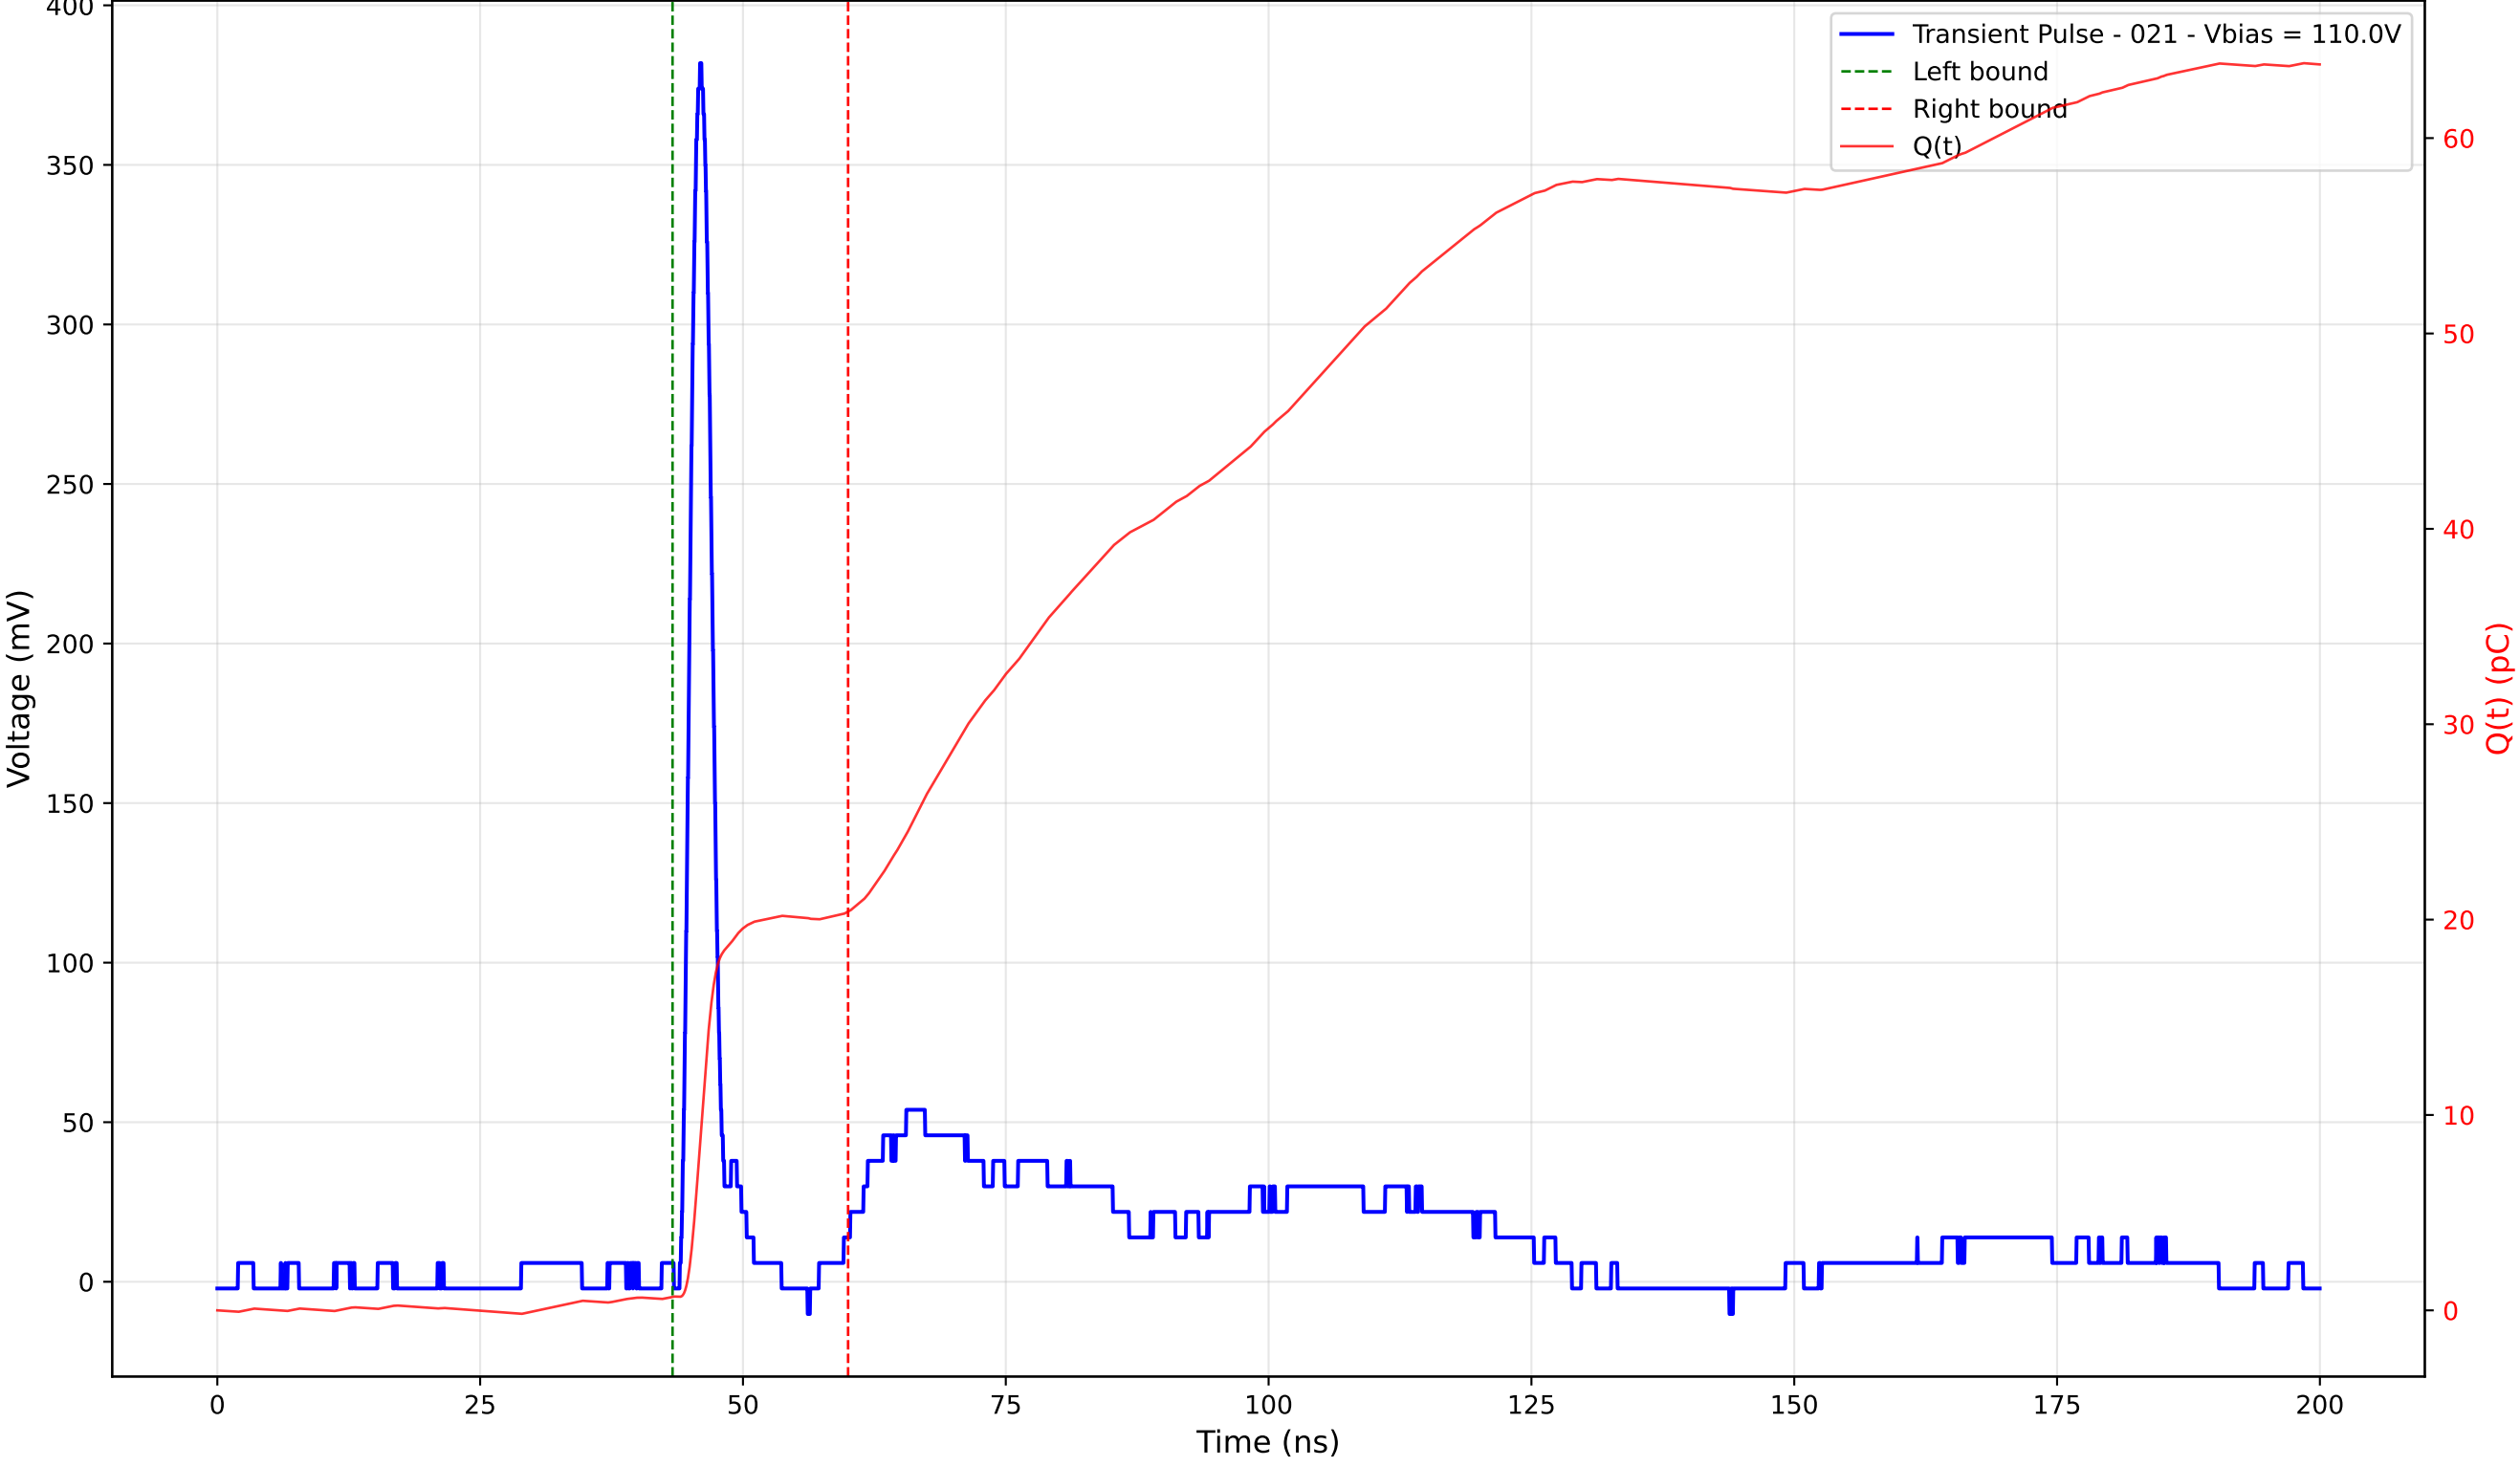


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 18.72 pC - Rise Time: 1.17 ns

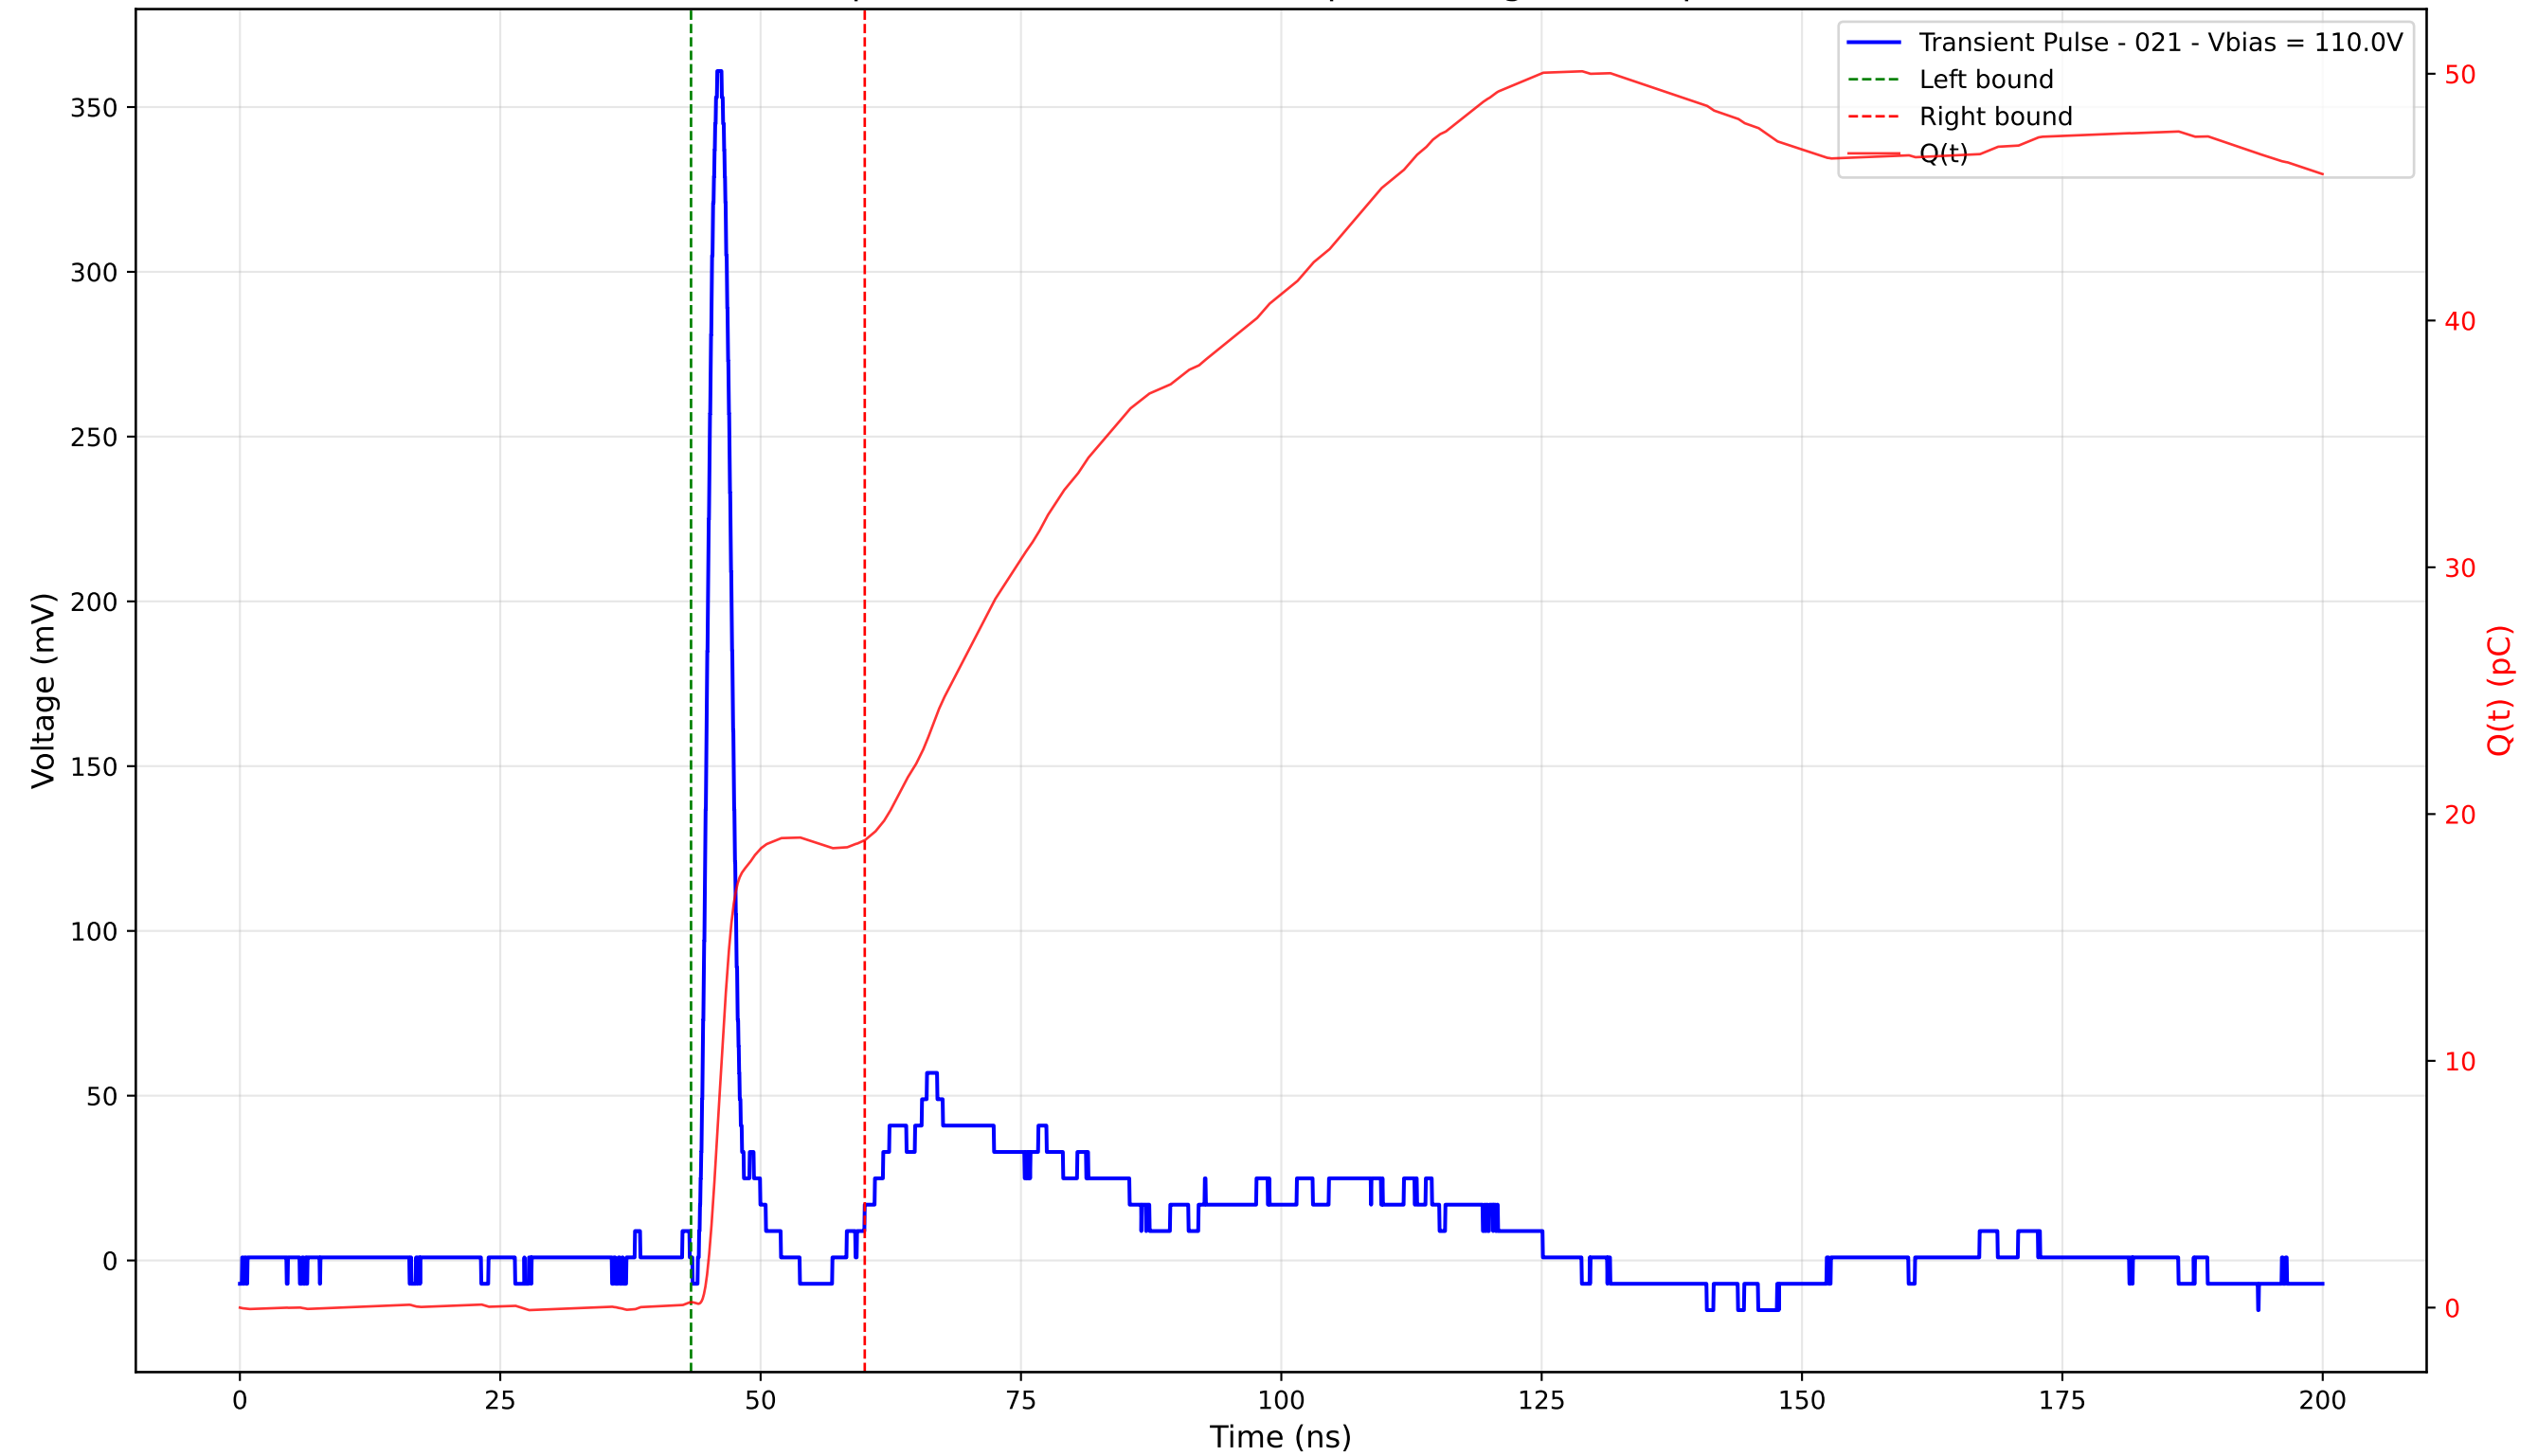


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 19.02 pC - Rise Time: 1.18 ns

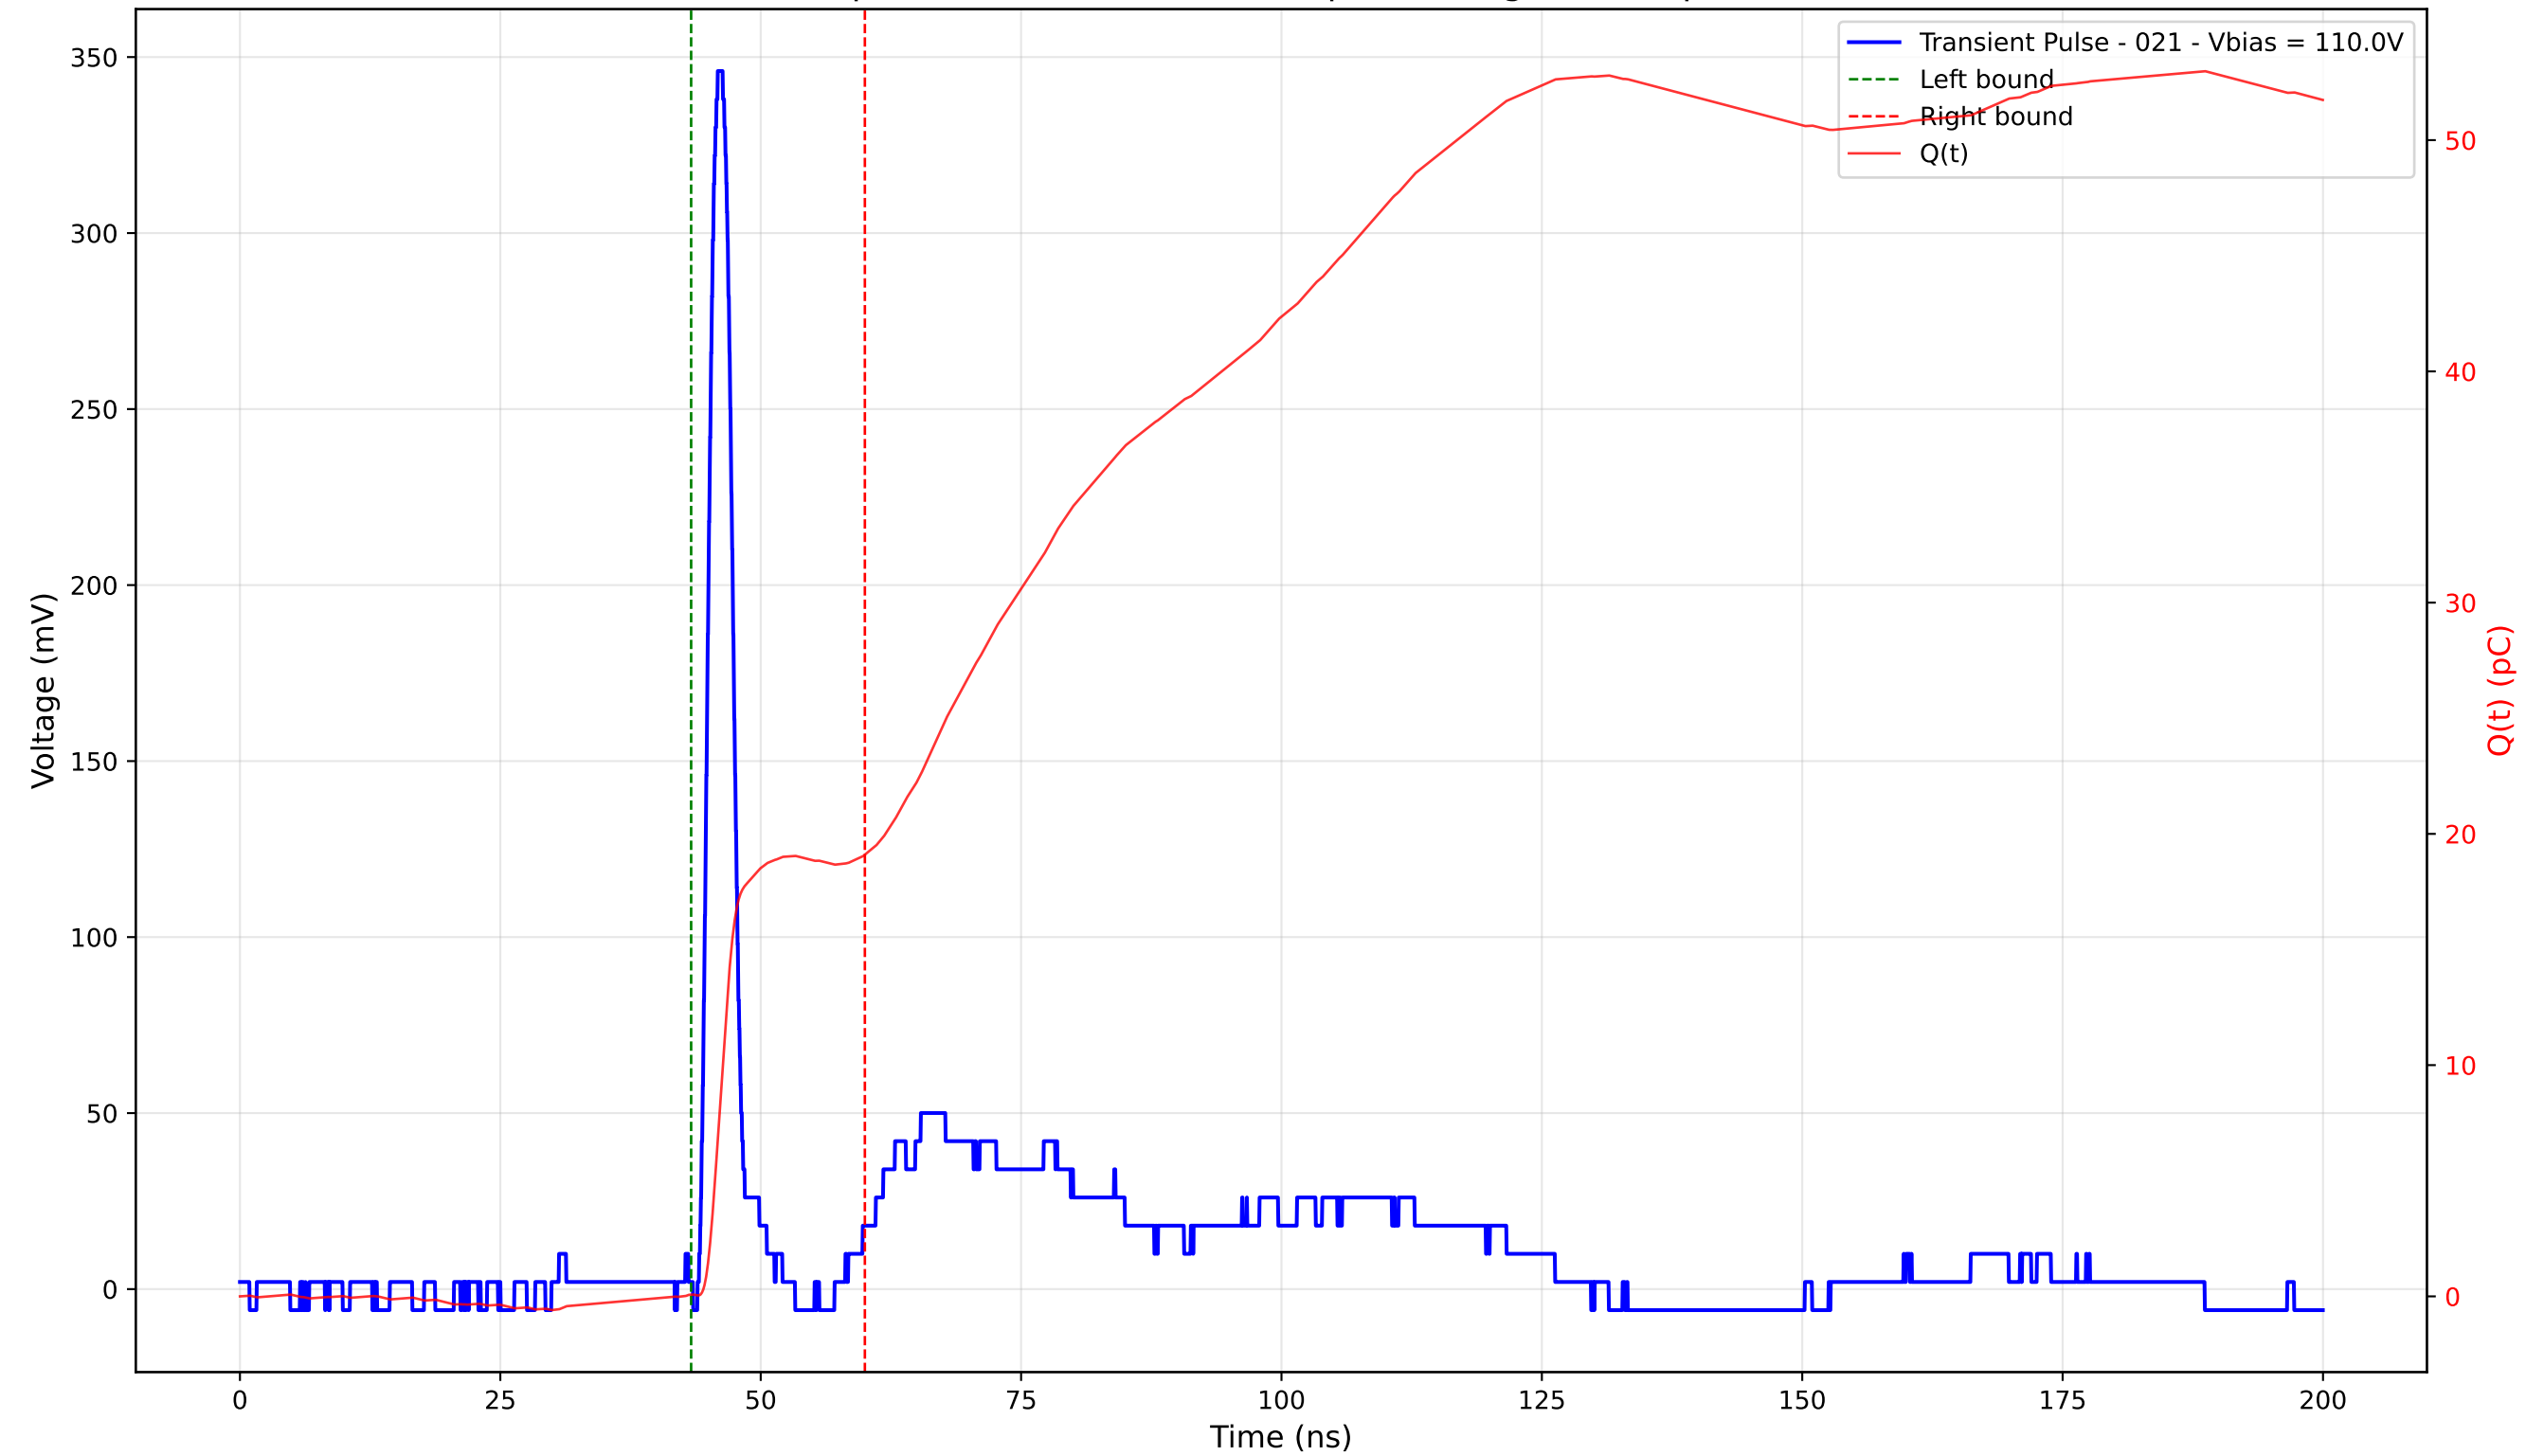


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 19.19 pC - Rise Time: 1.20 ns

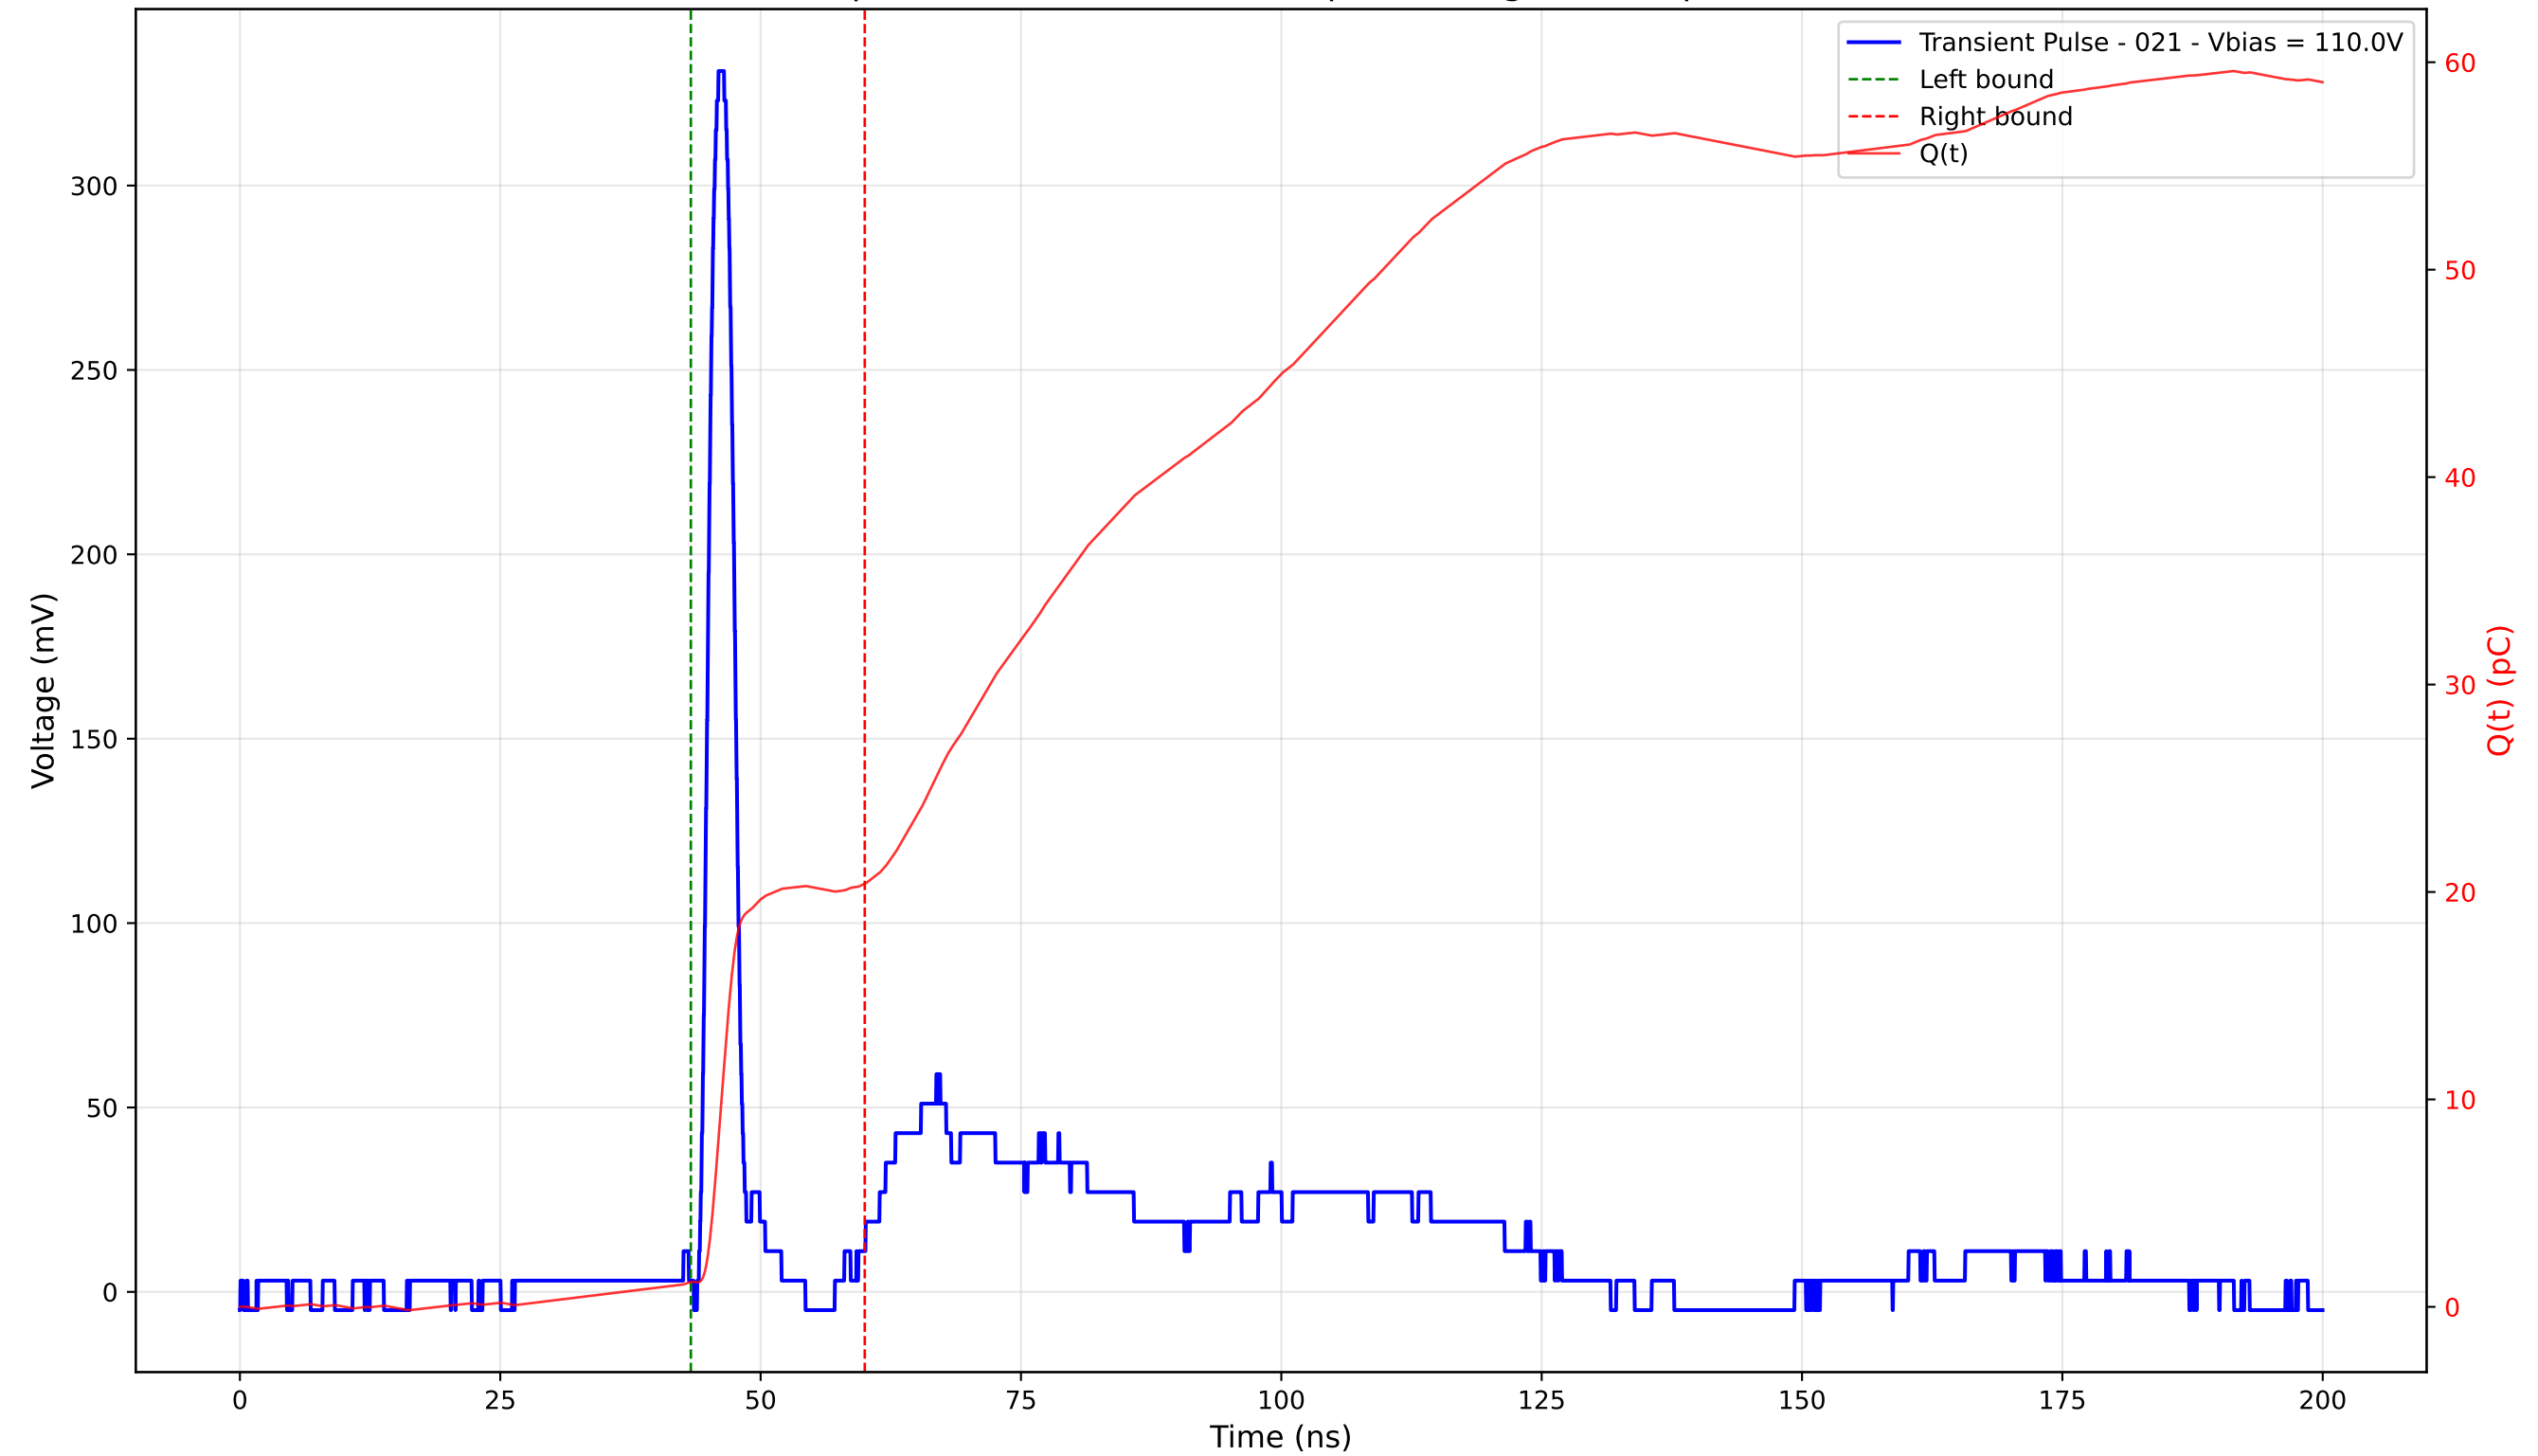


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 18.11 pC - Rise Time: 1.37 ns

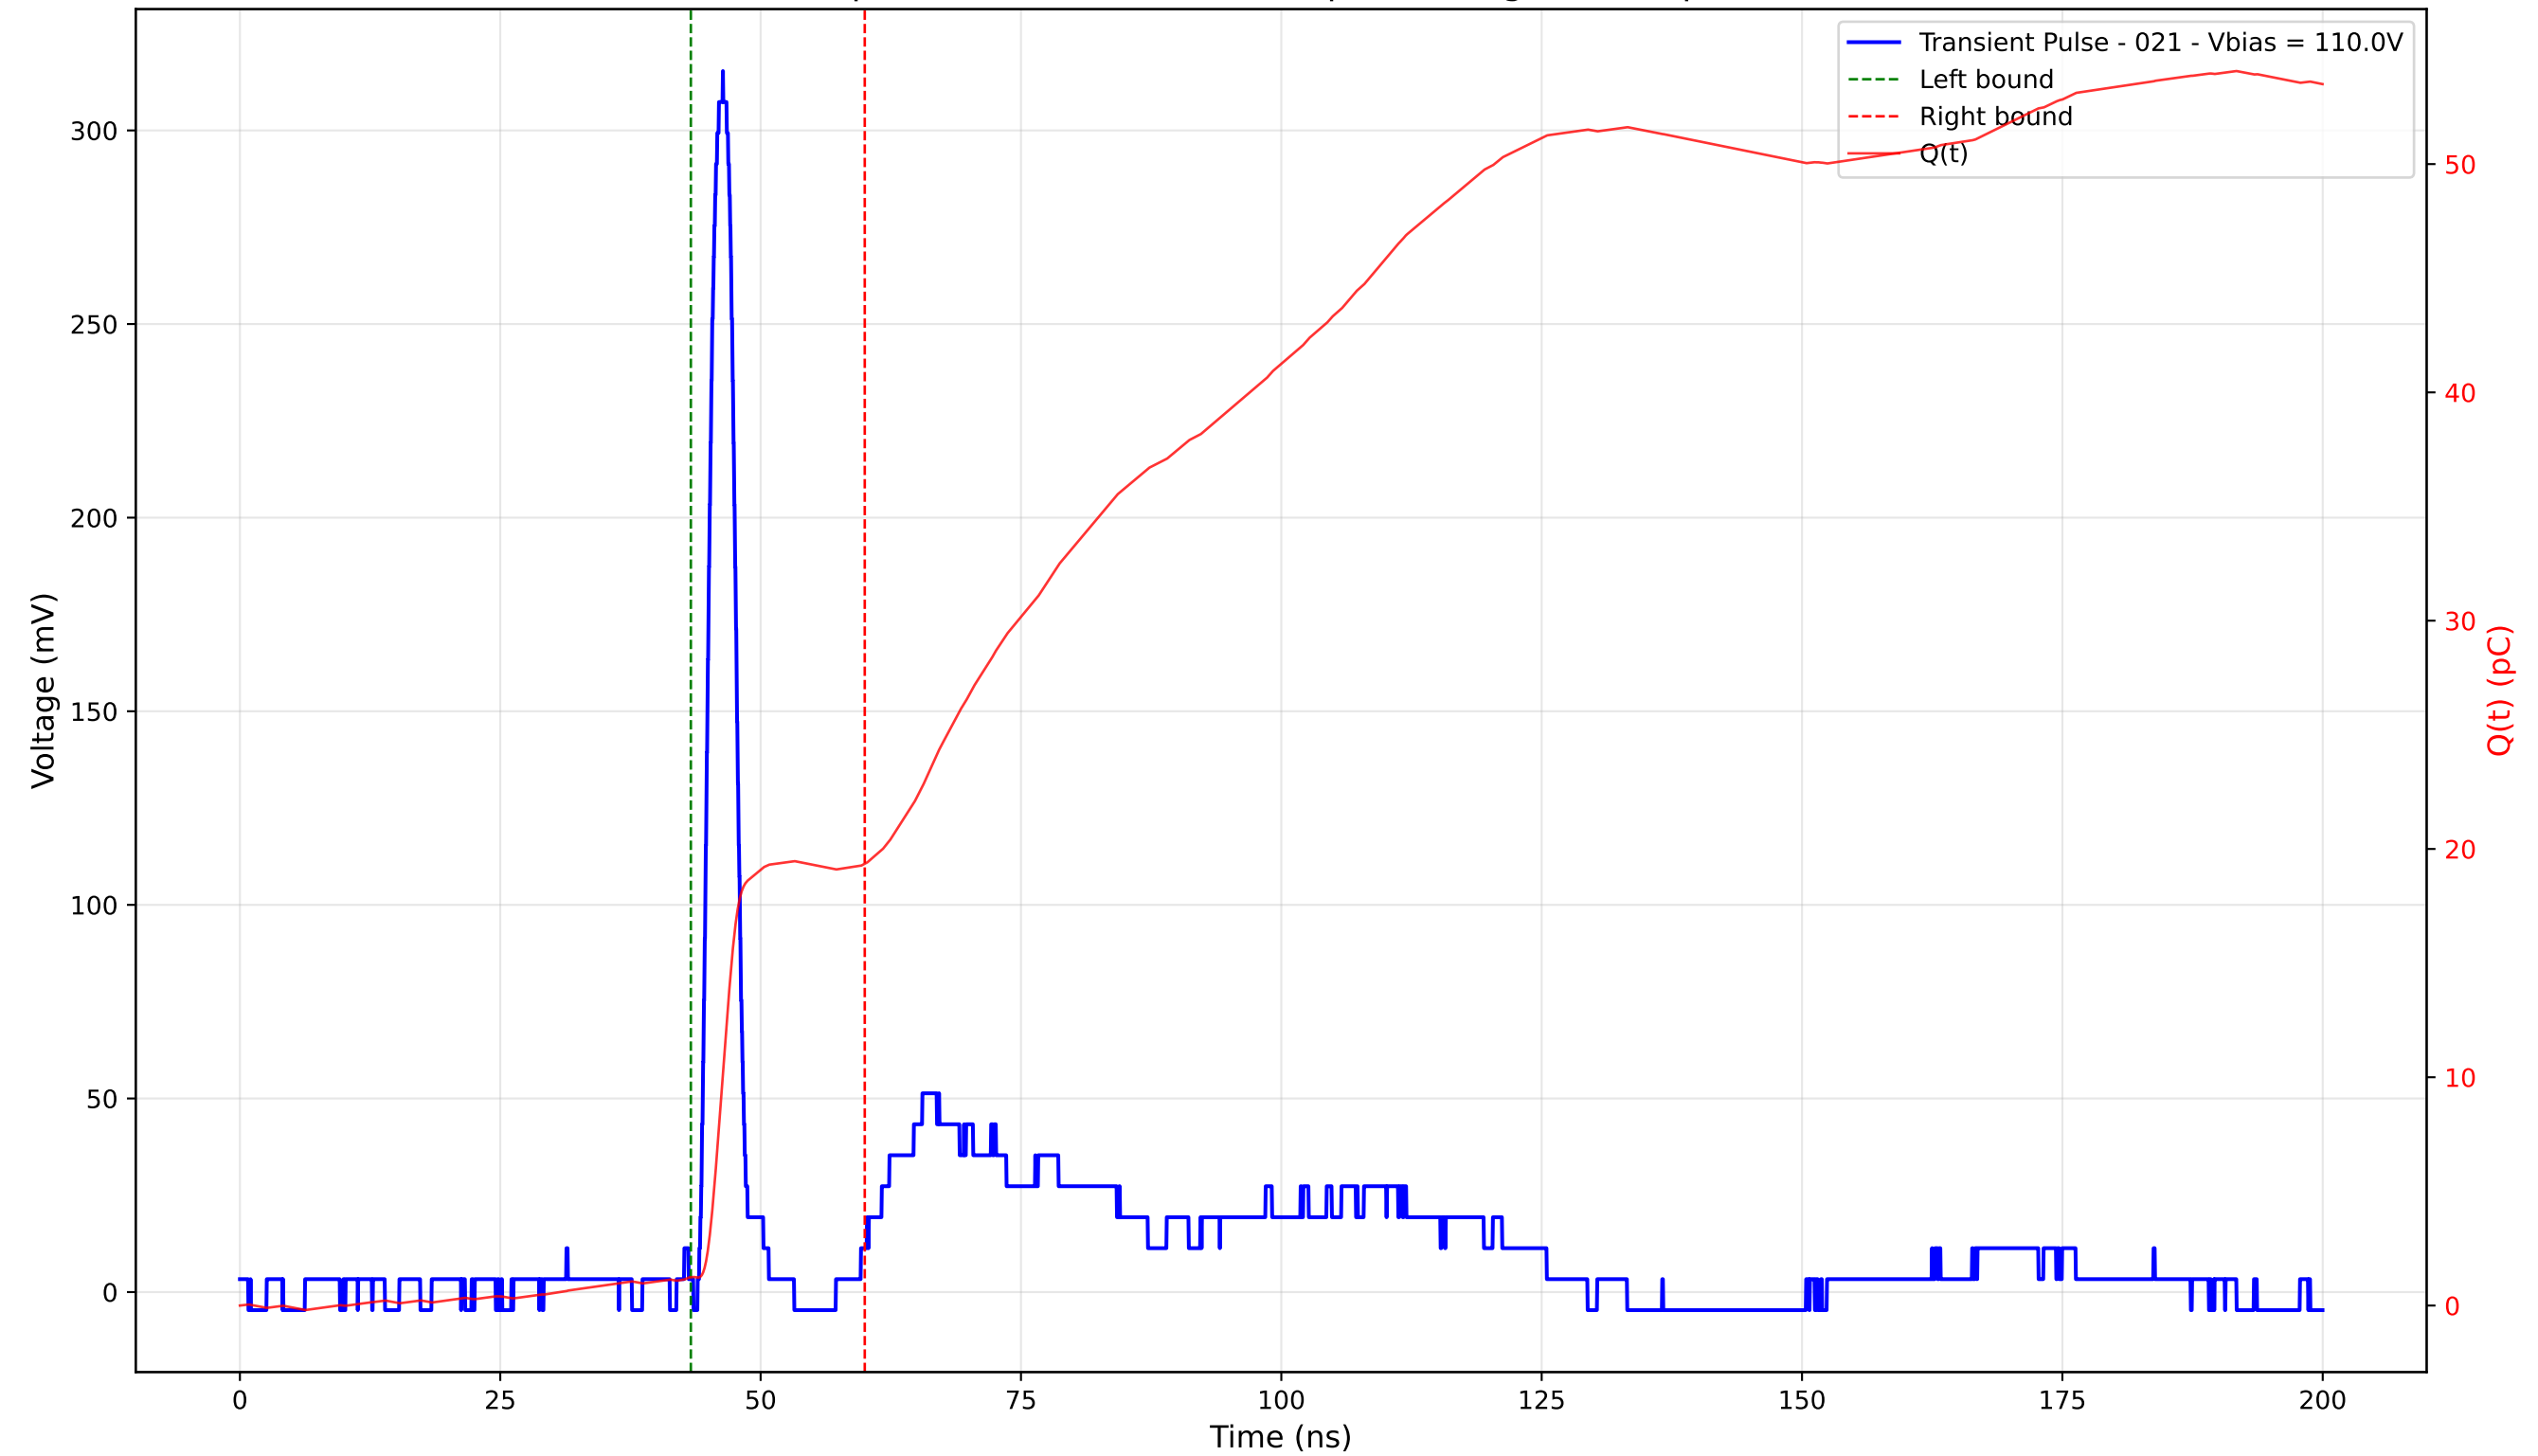


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 18.36 pC - Rise Time: 1.28 ns

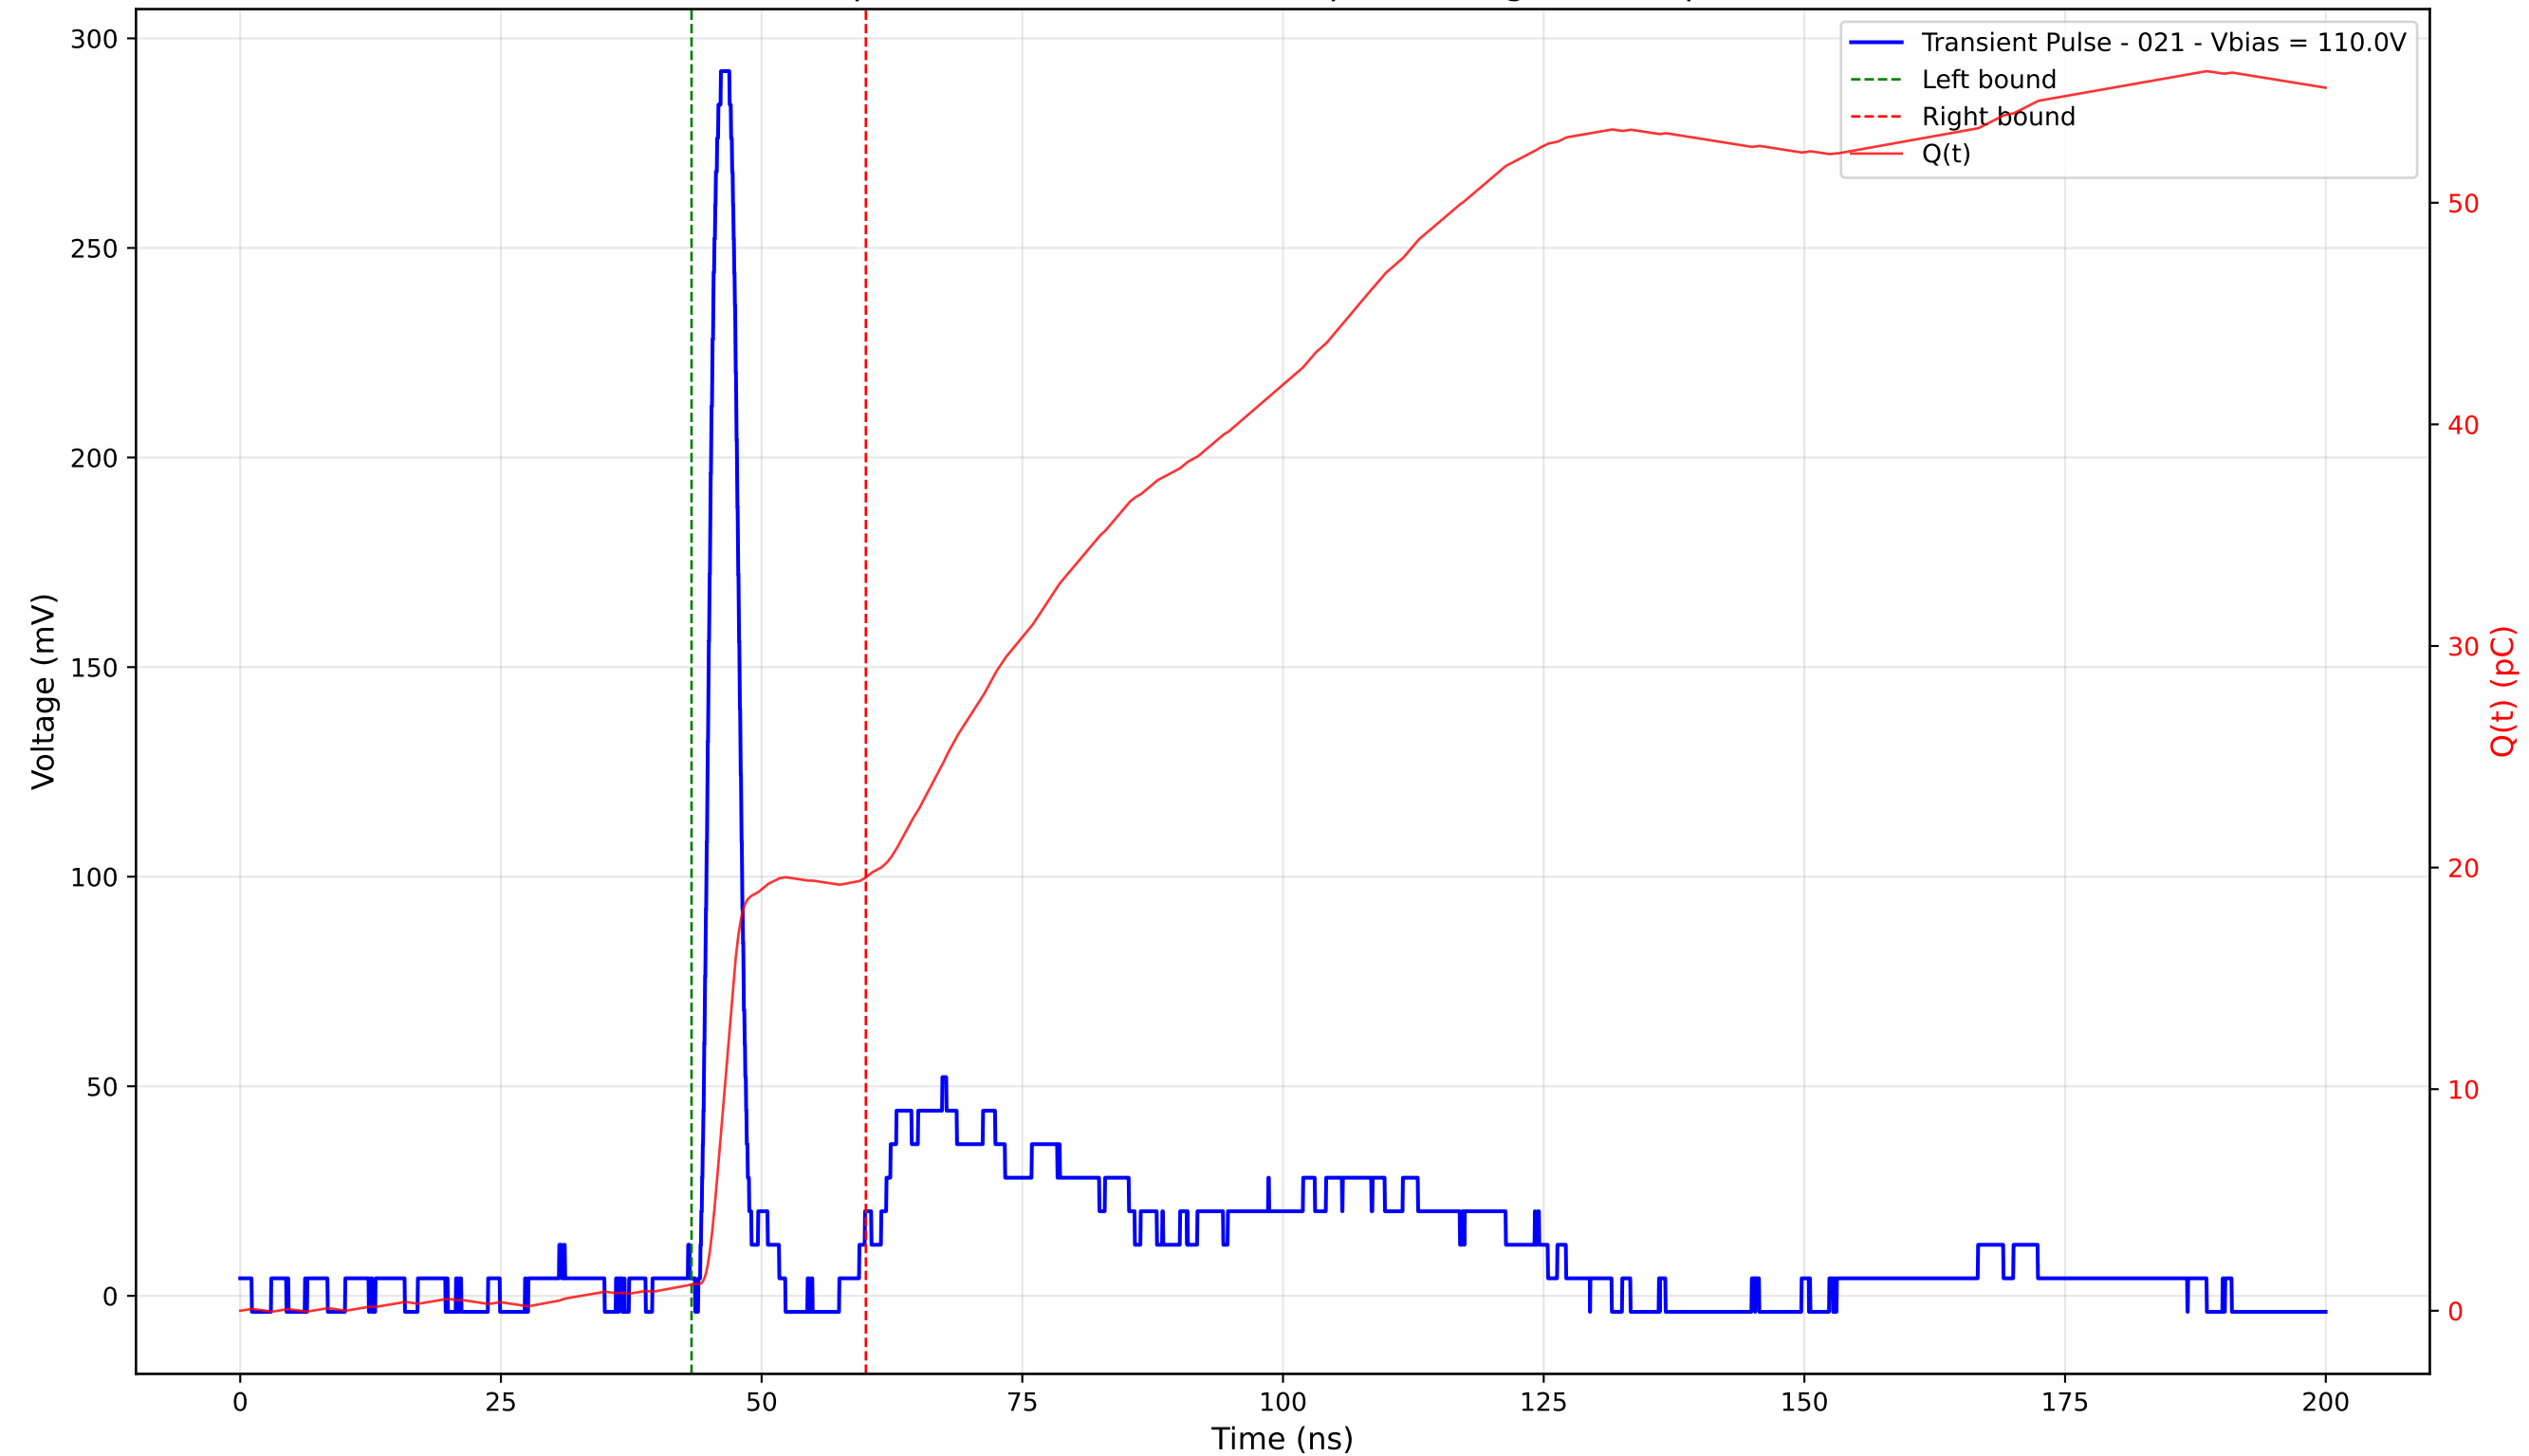


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 17.62 pC - Rise Time: 1.32 ns

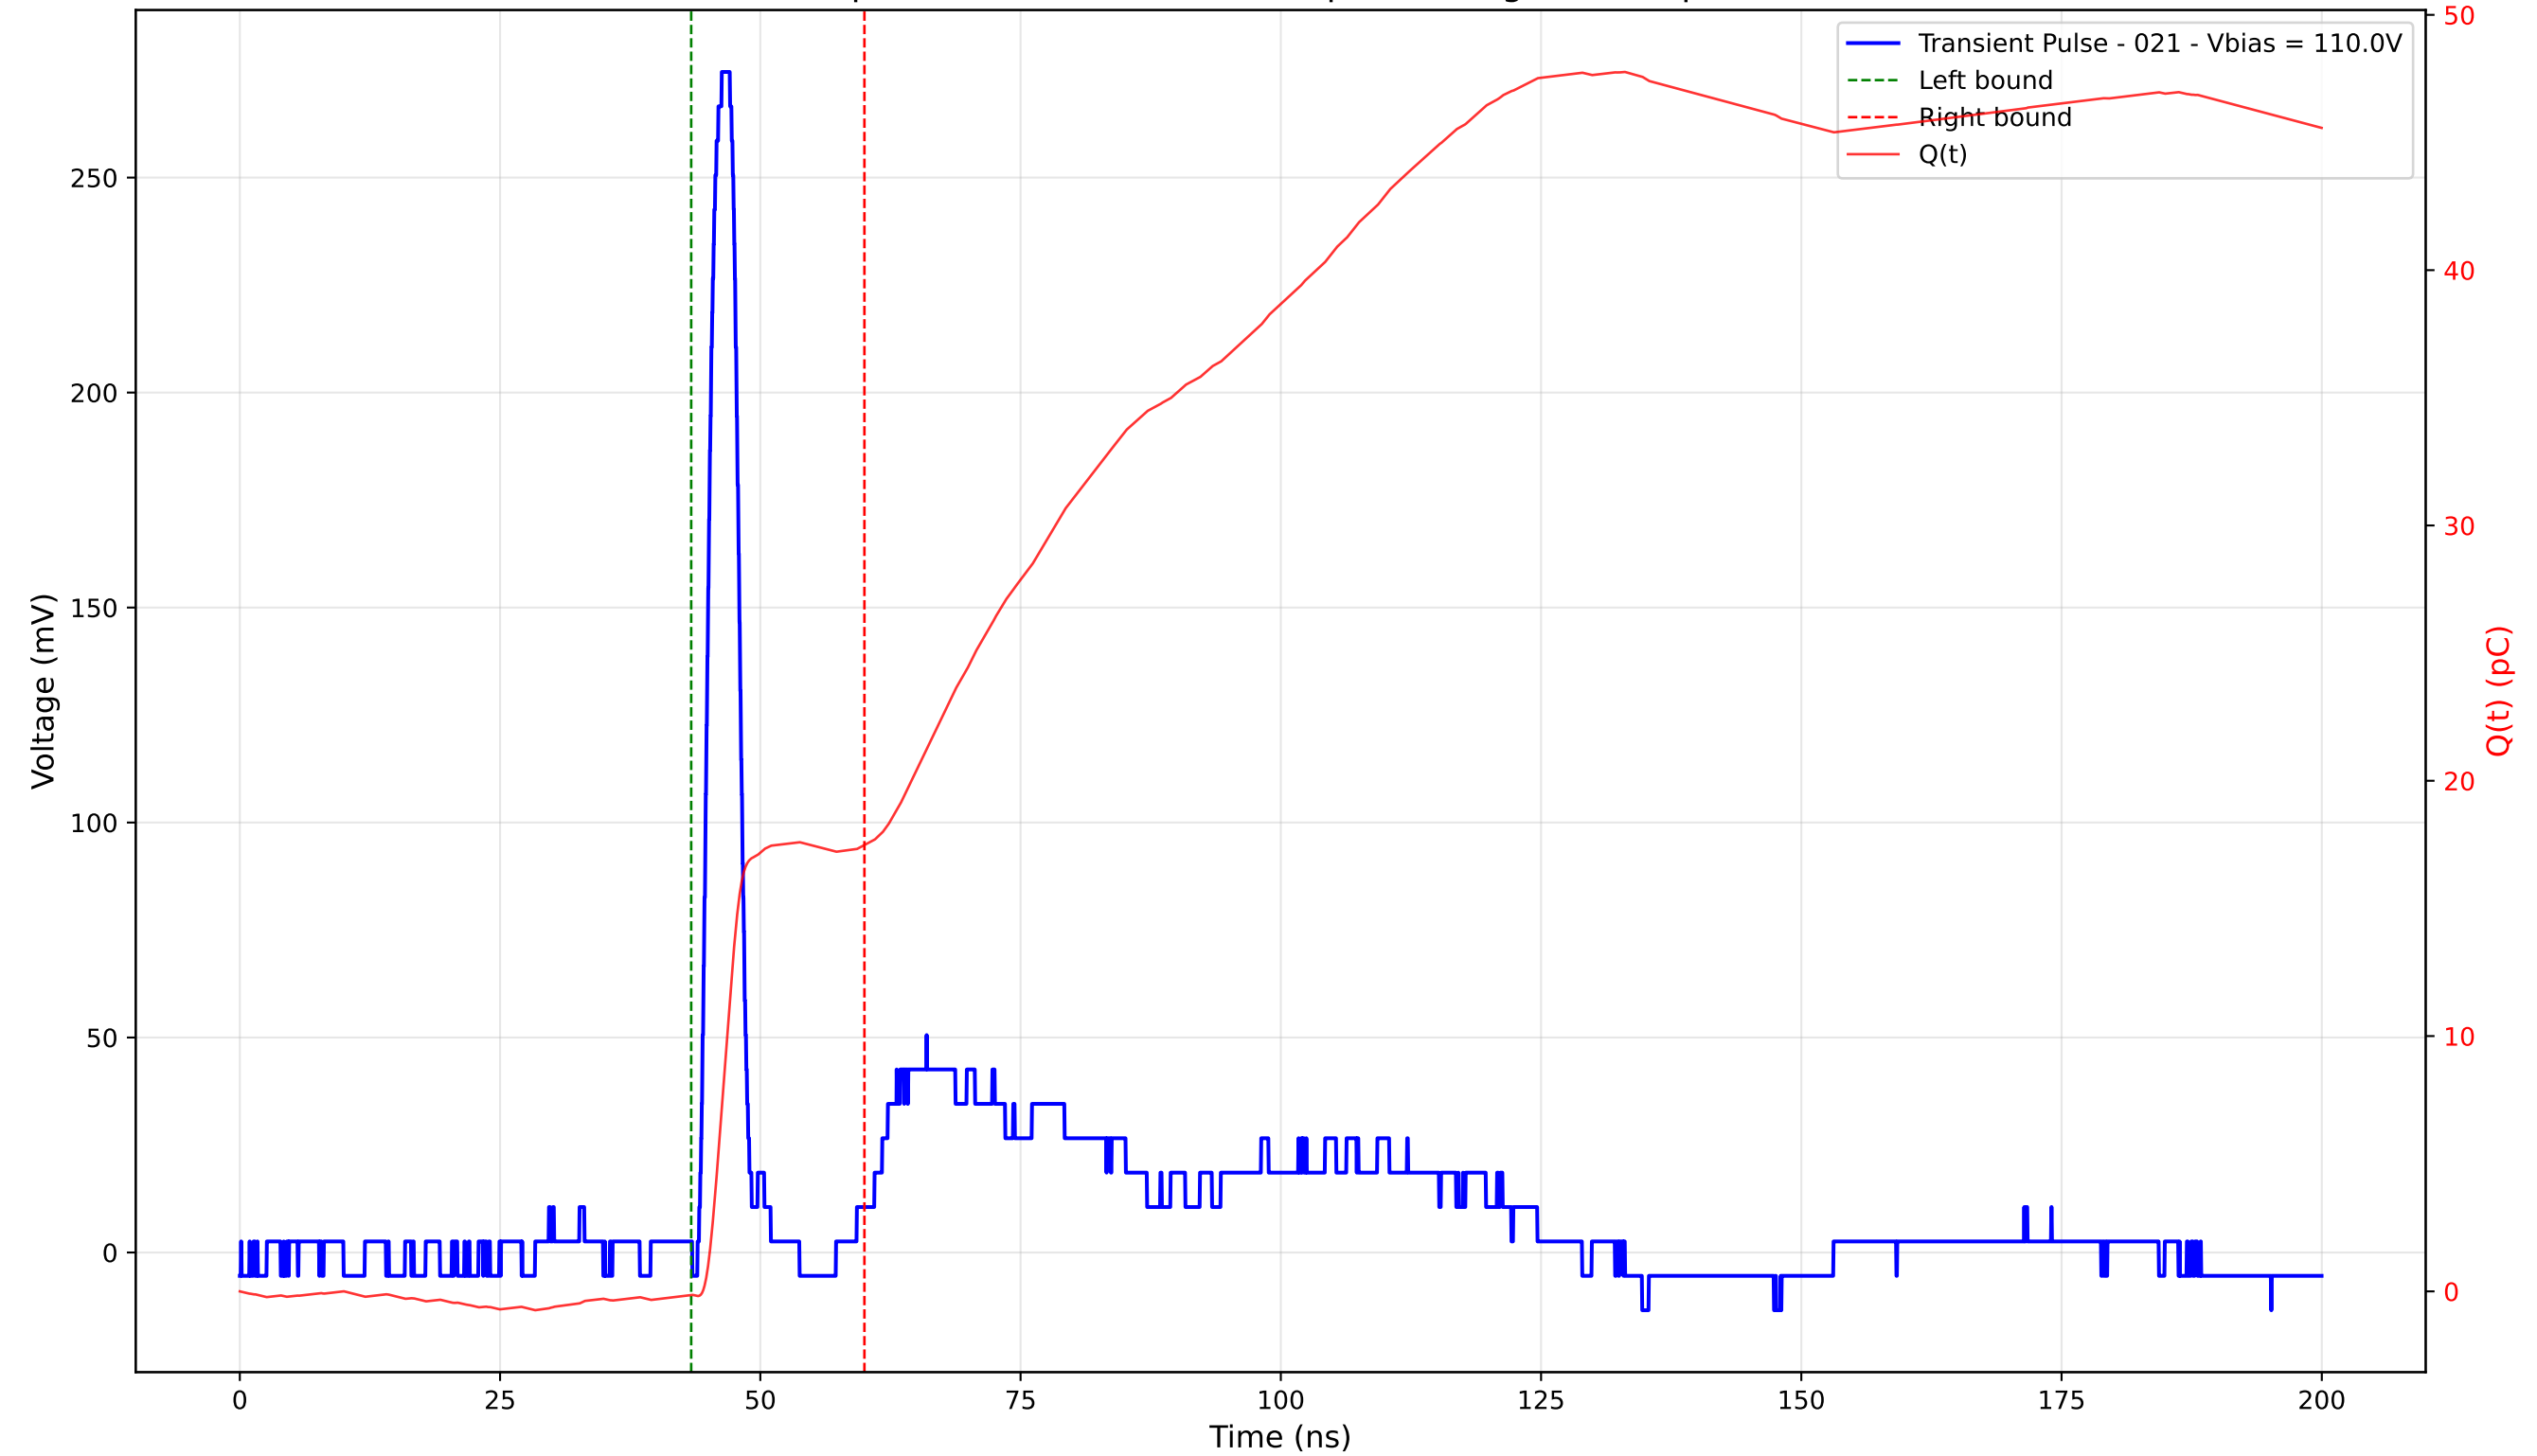


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 17.62 pC - Rise Time: 1.58 ns

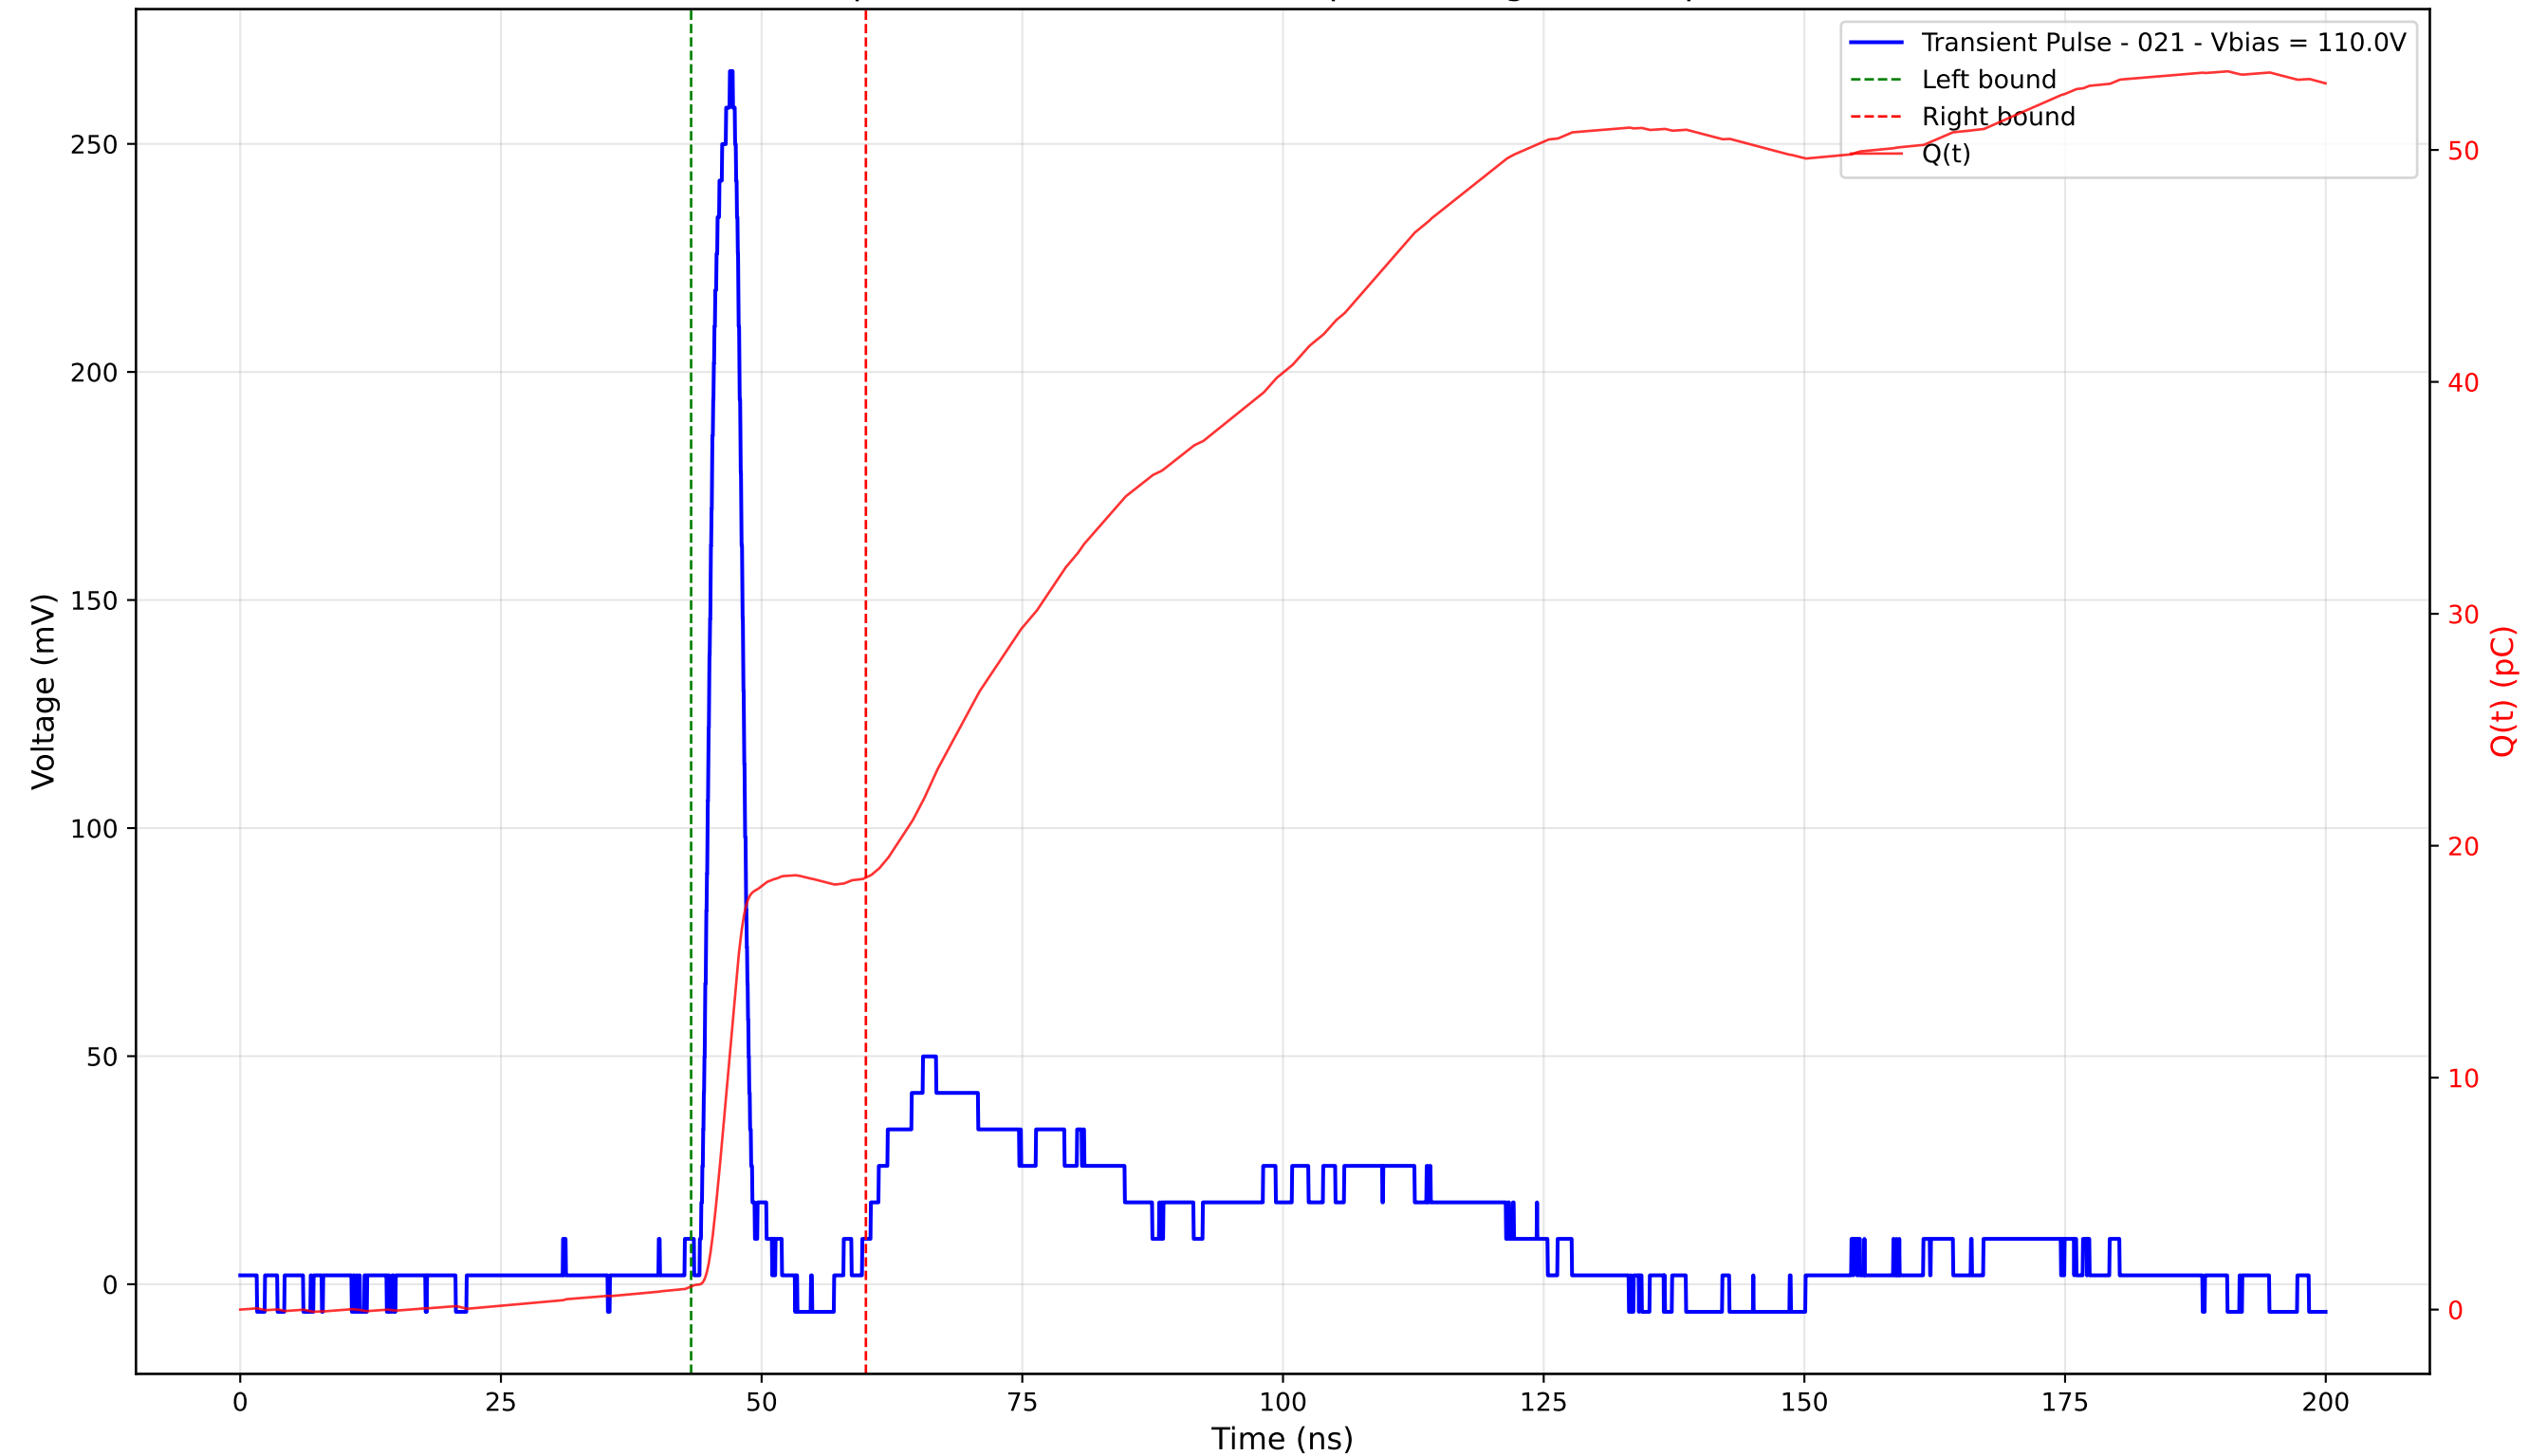


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 18.25 pC - Rise Time: 1.72 ns

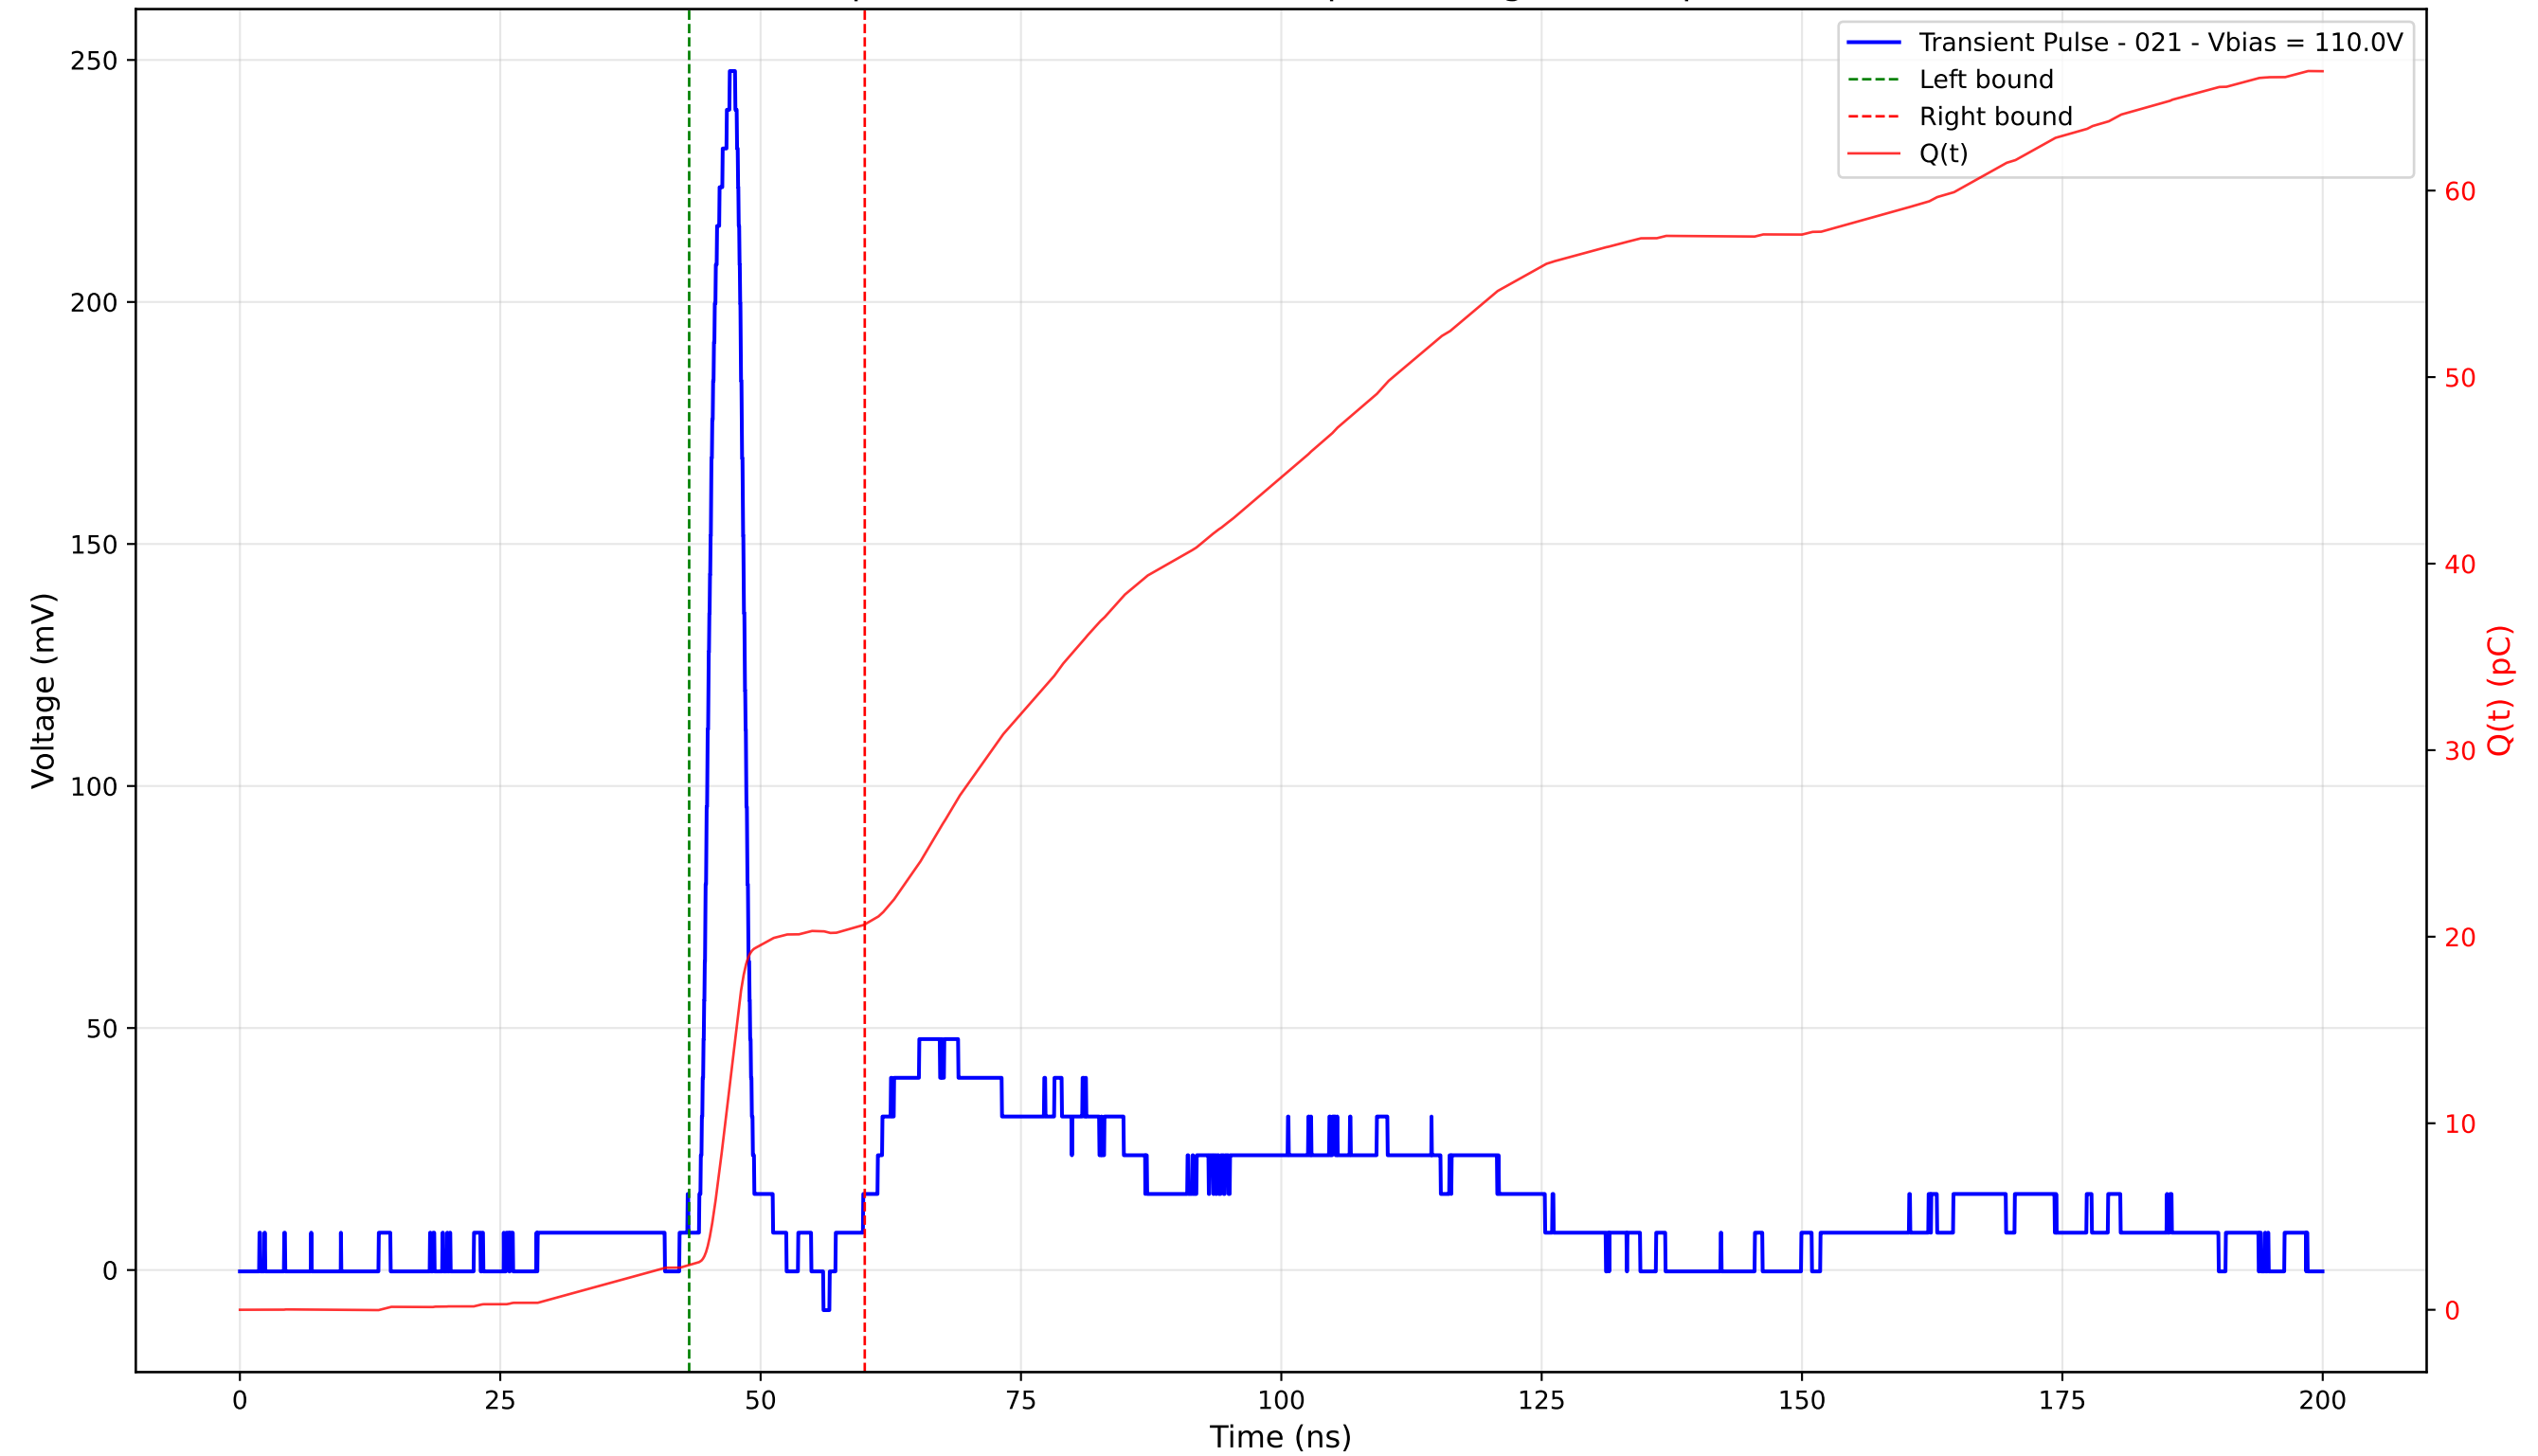


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 15.89 pC - Rise Time: 2.62 ns

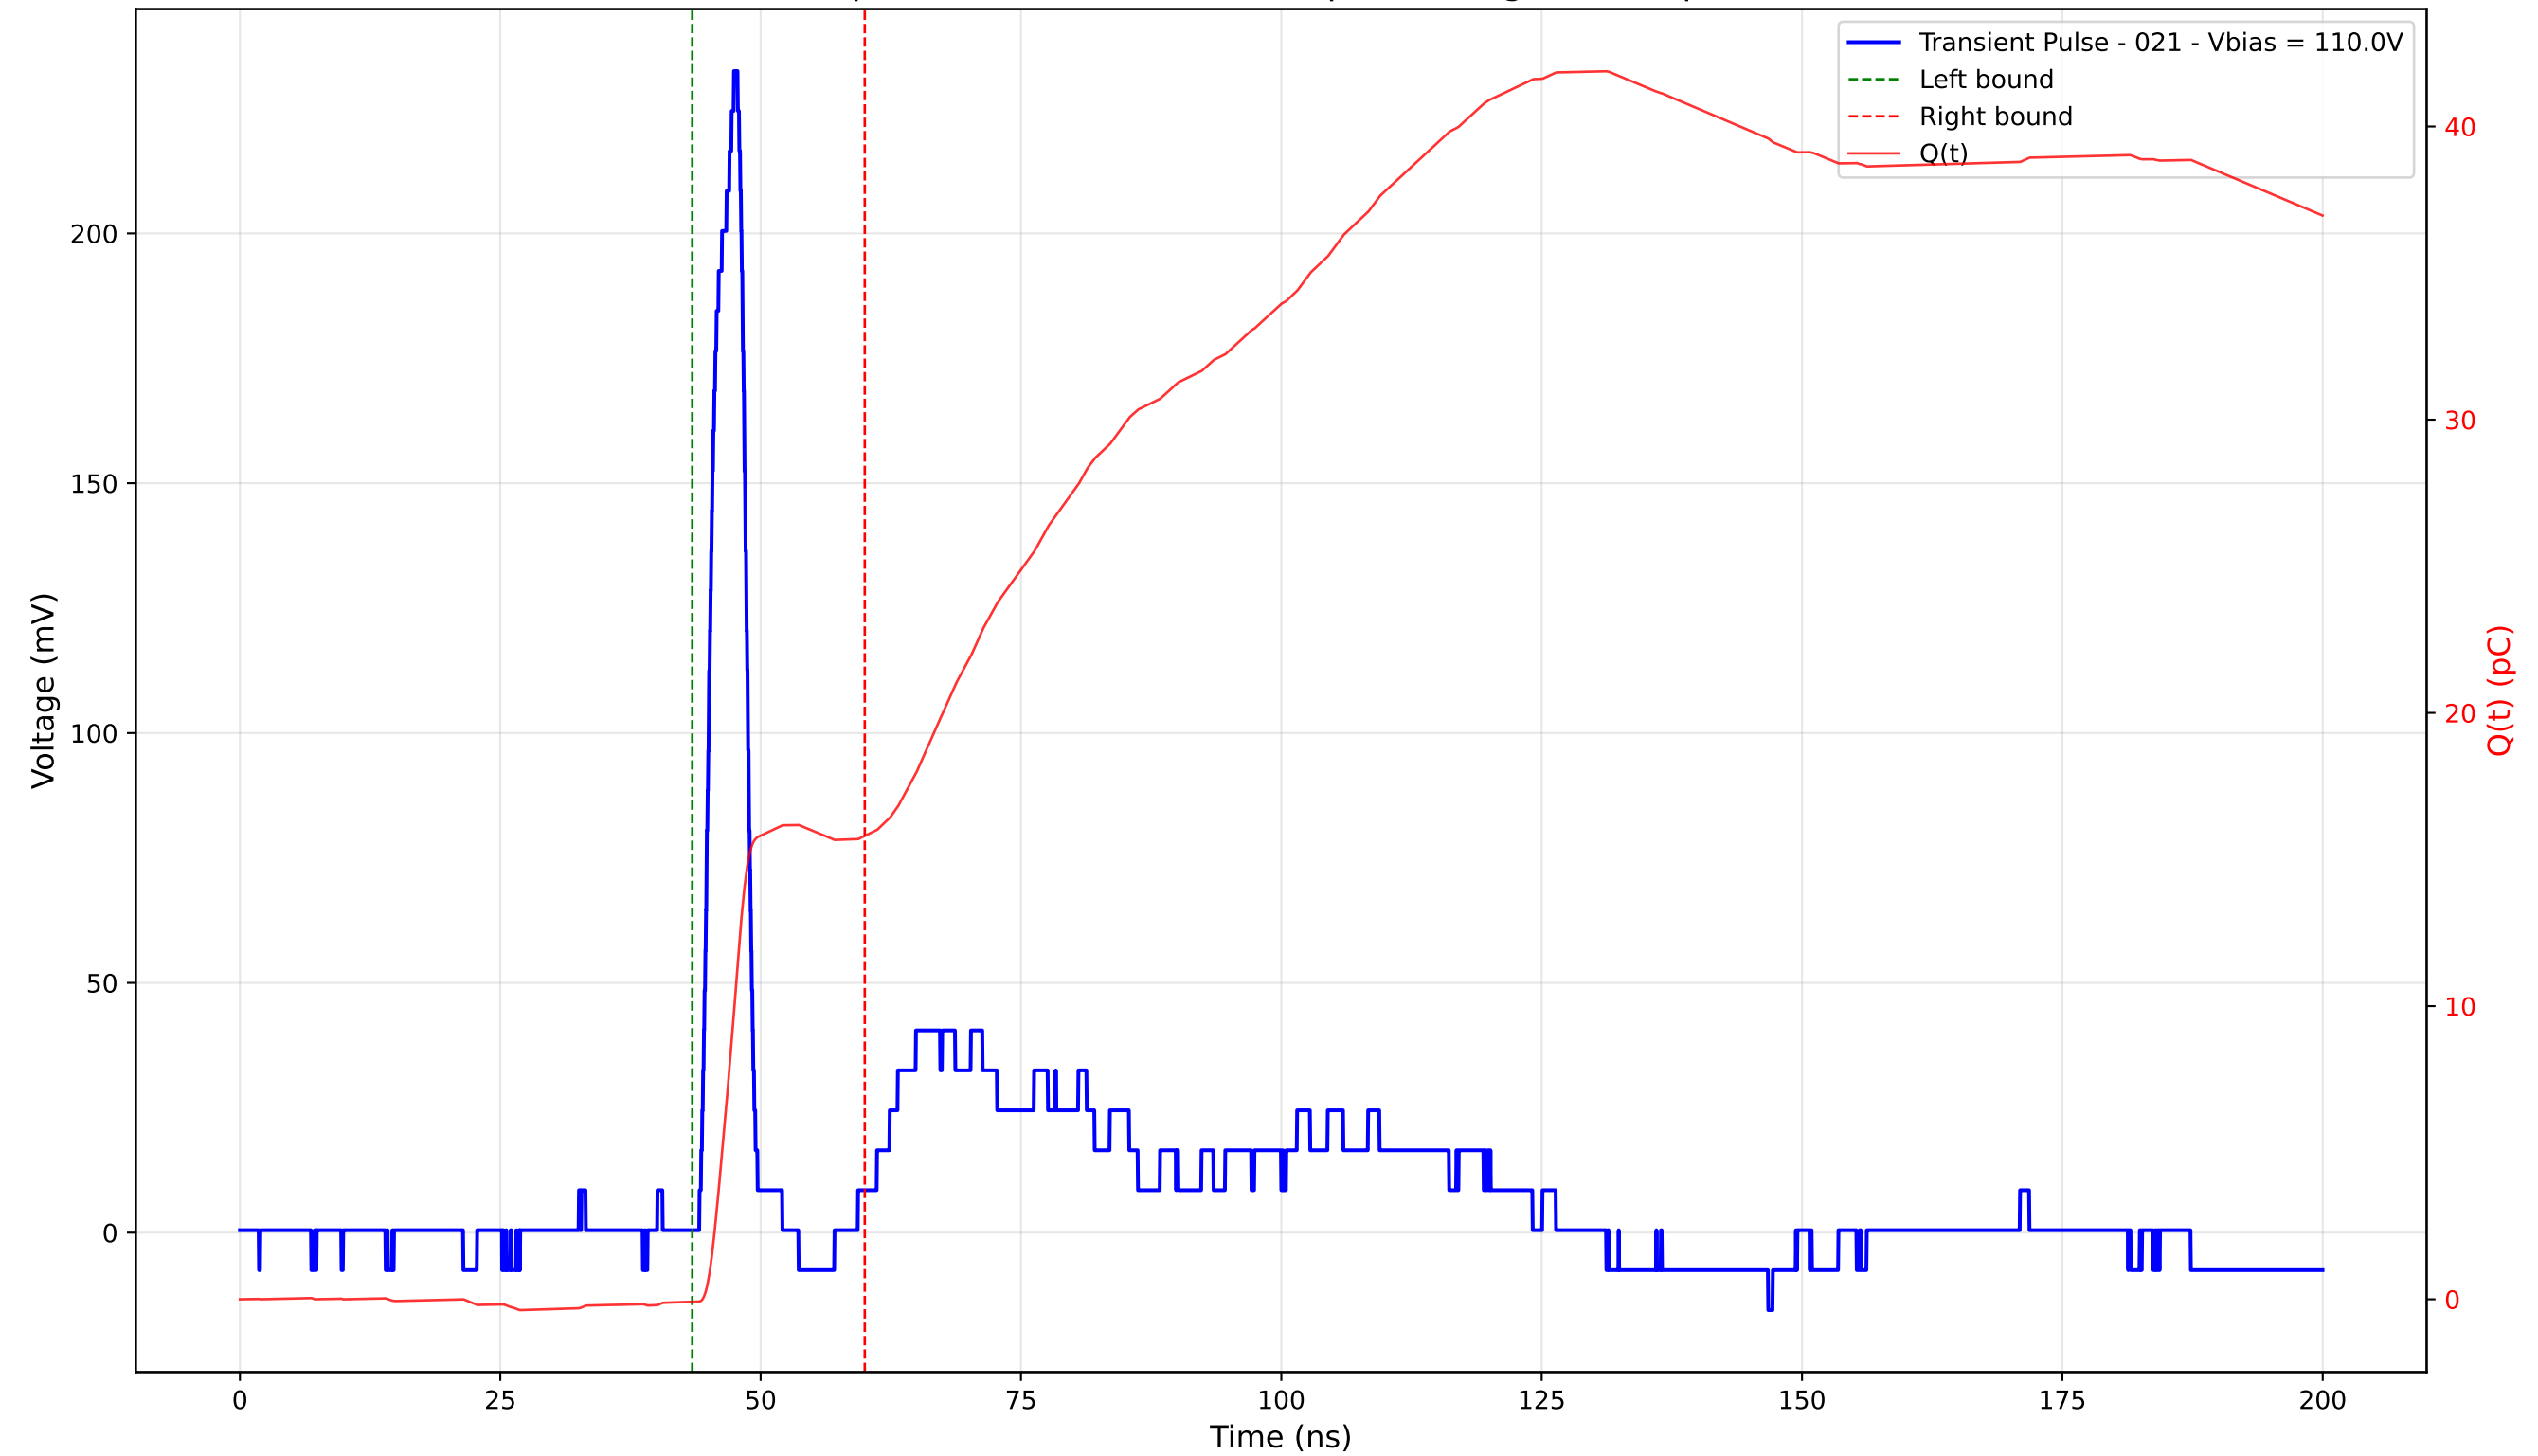


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 16.30 pC - Rise Time: 2.77 ns

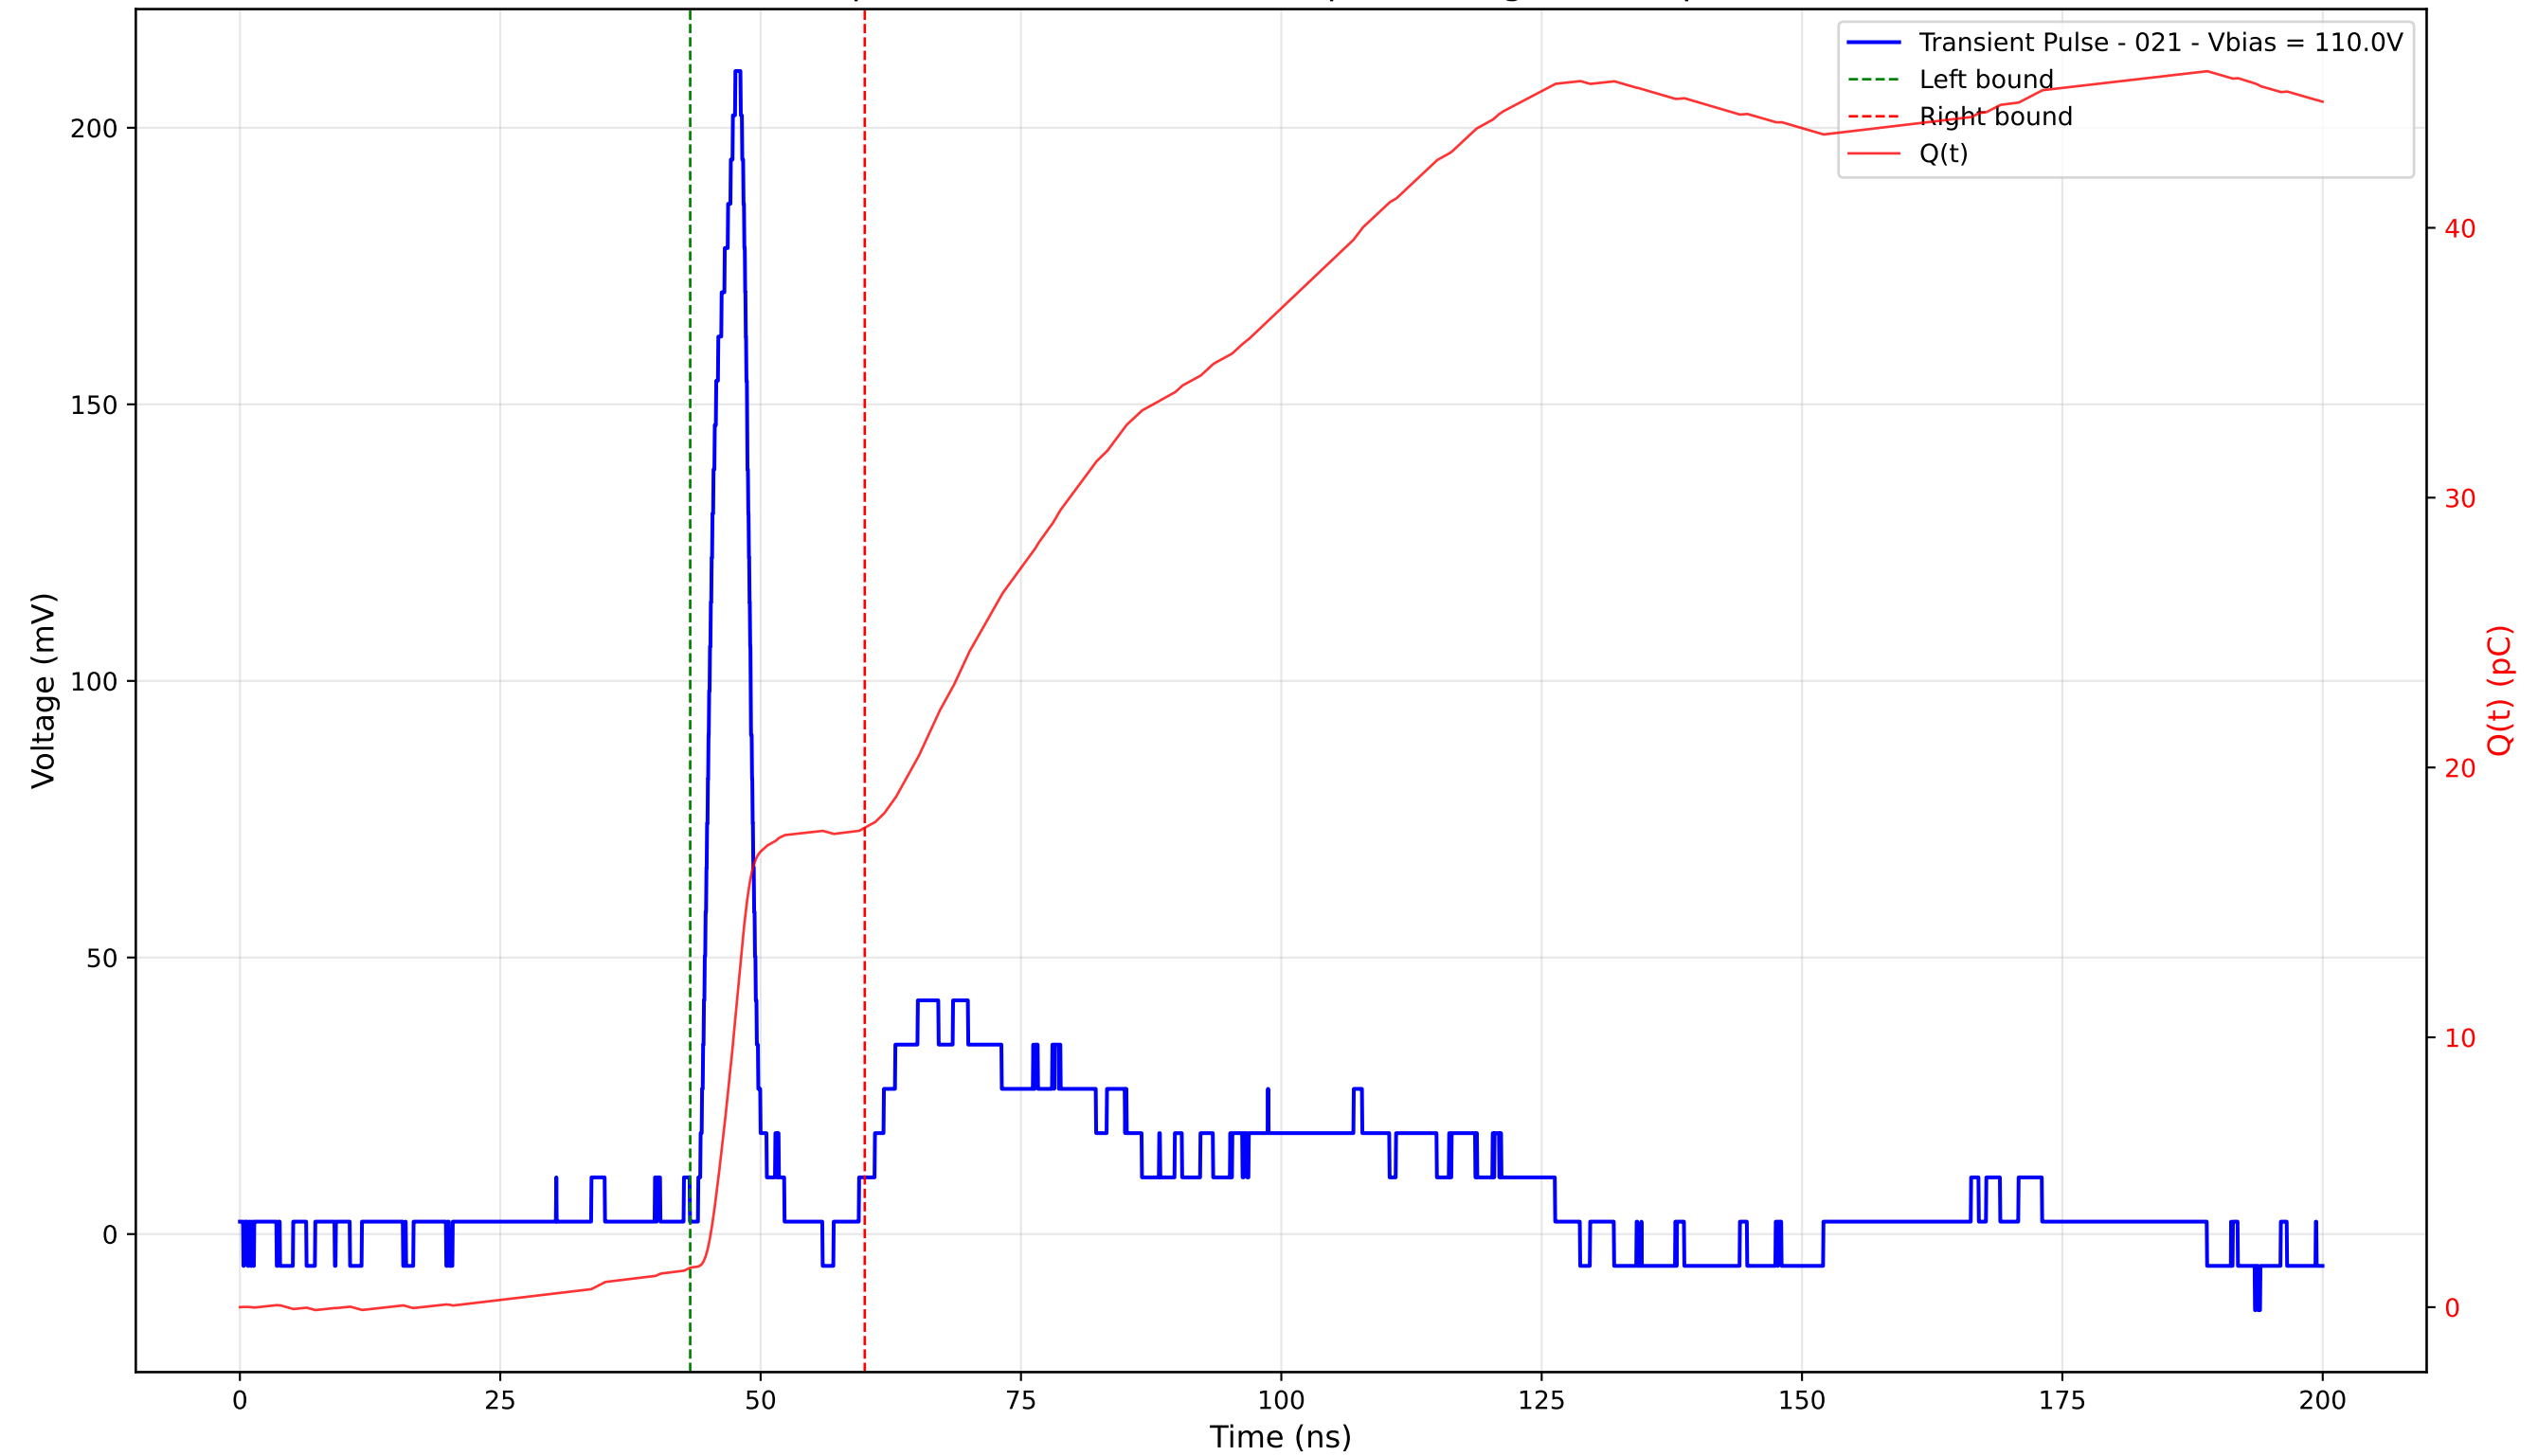


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 14.79 pC - Rise Time: 3.00 ns

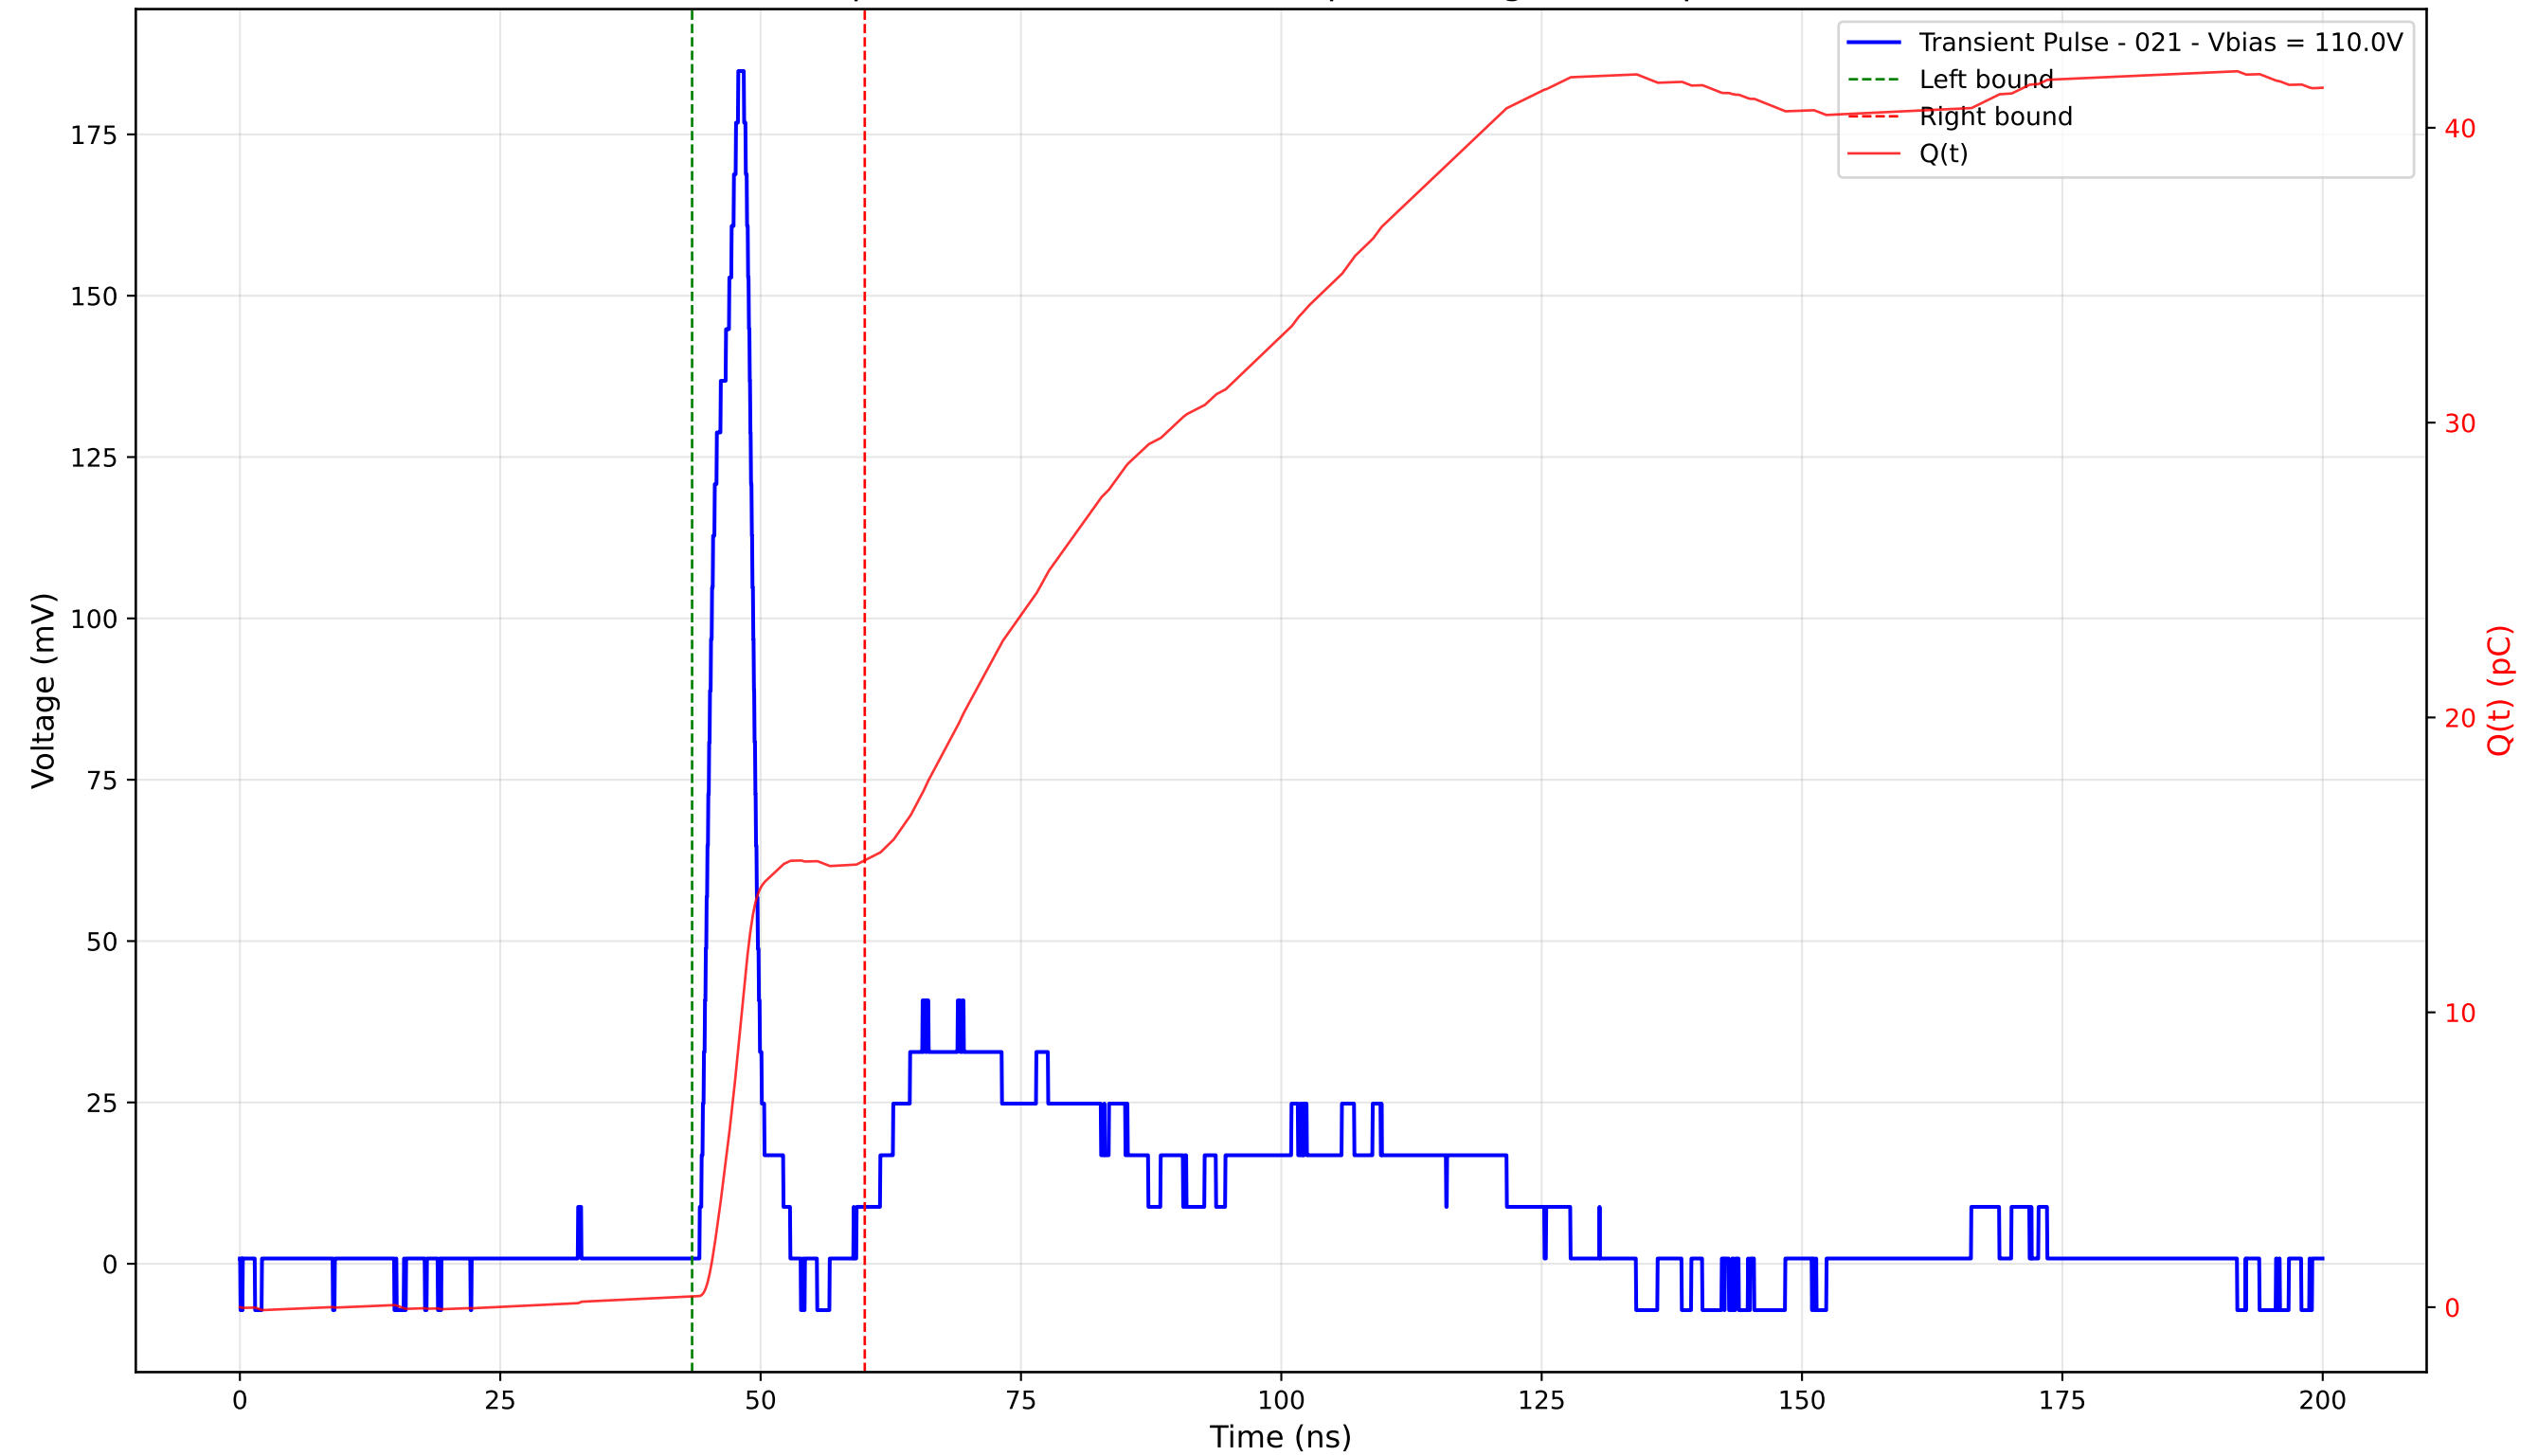


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 14.28 pC - Rise Time: 3.27 ns

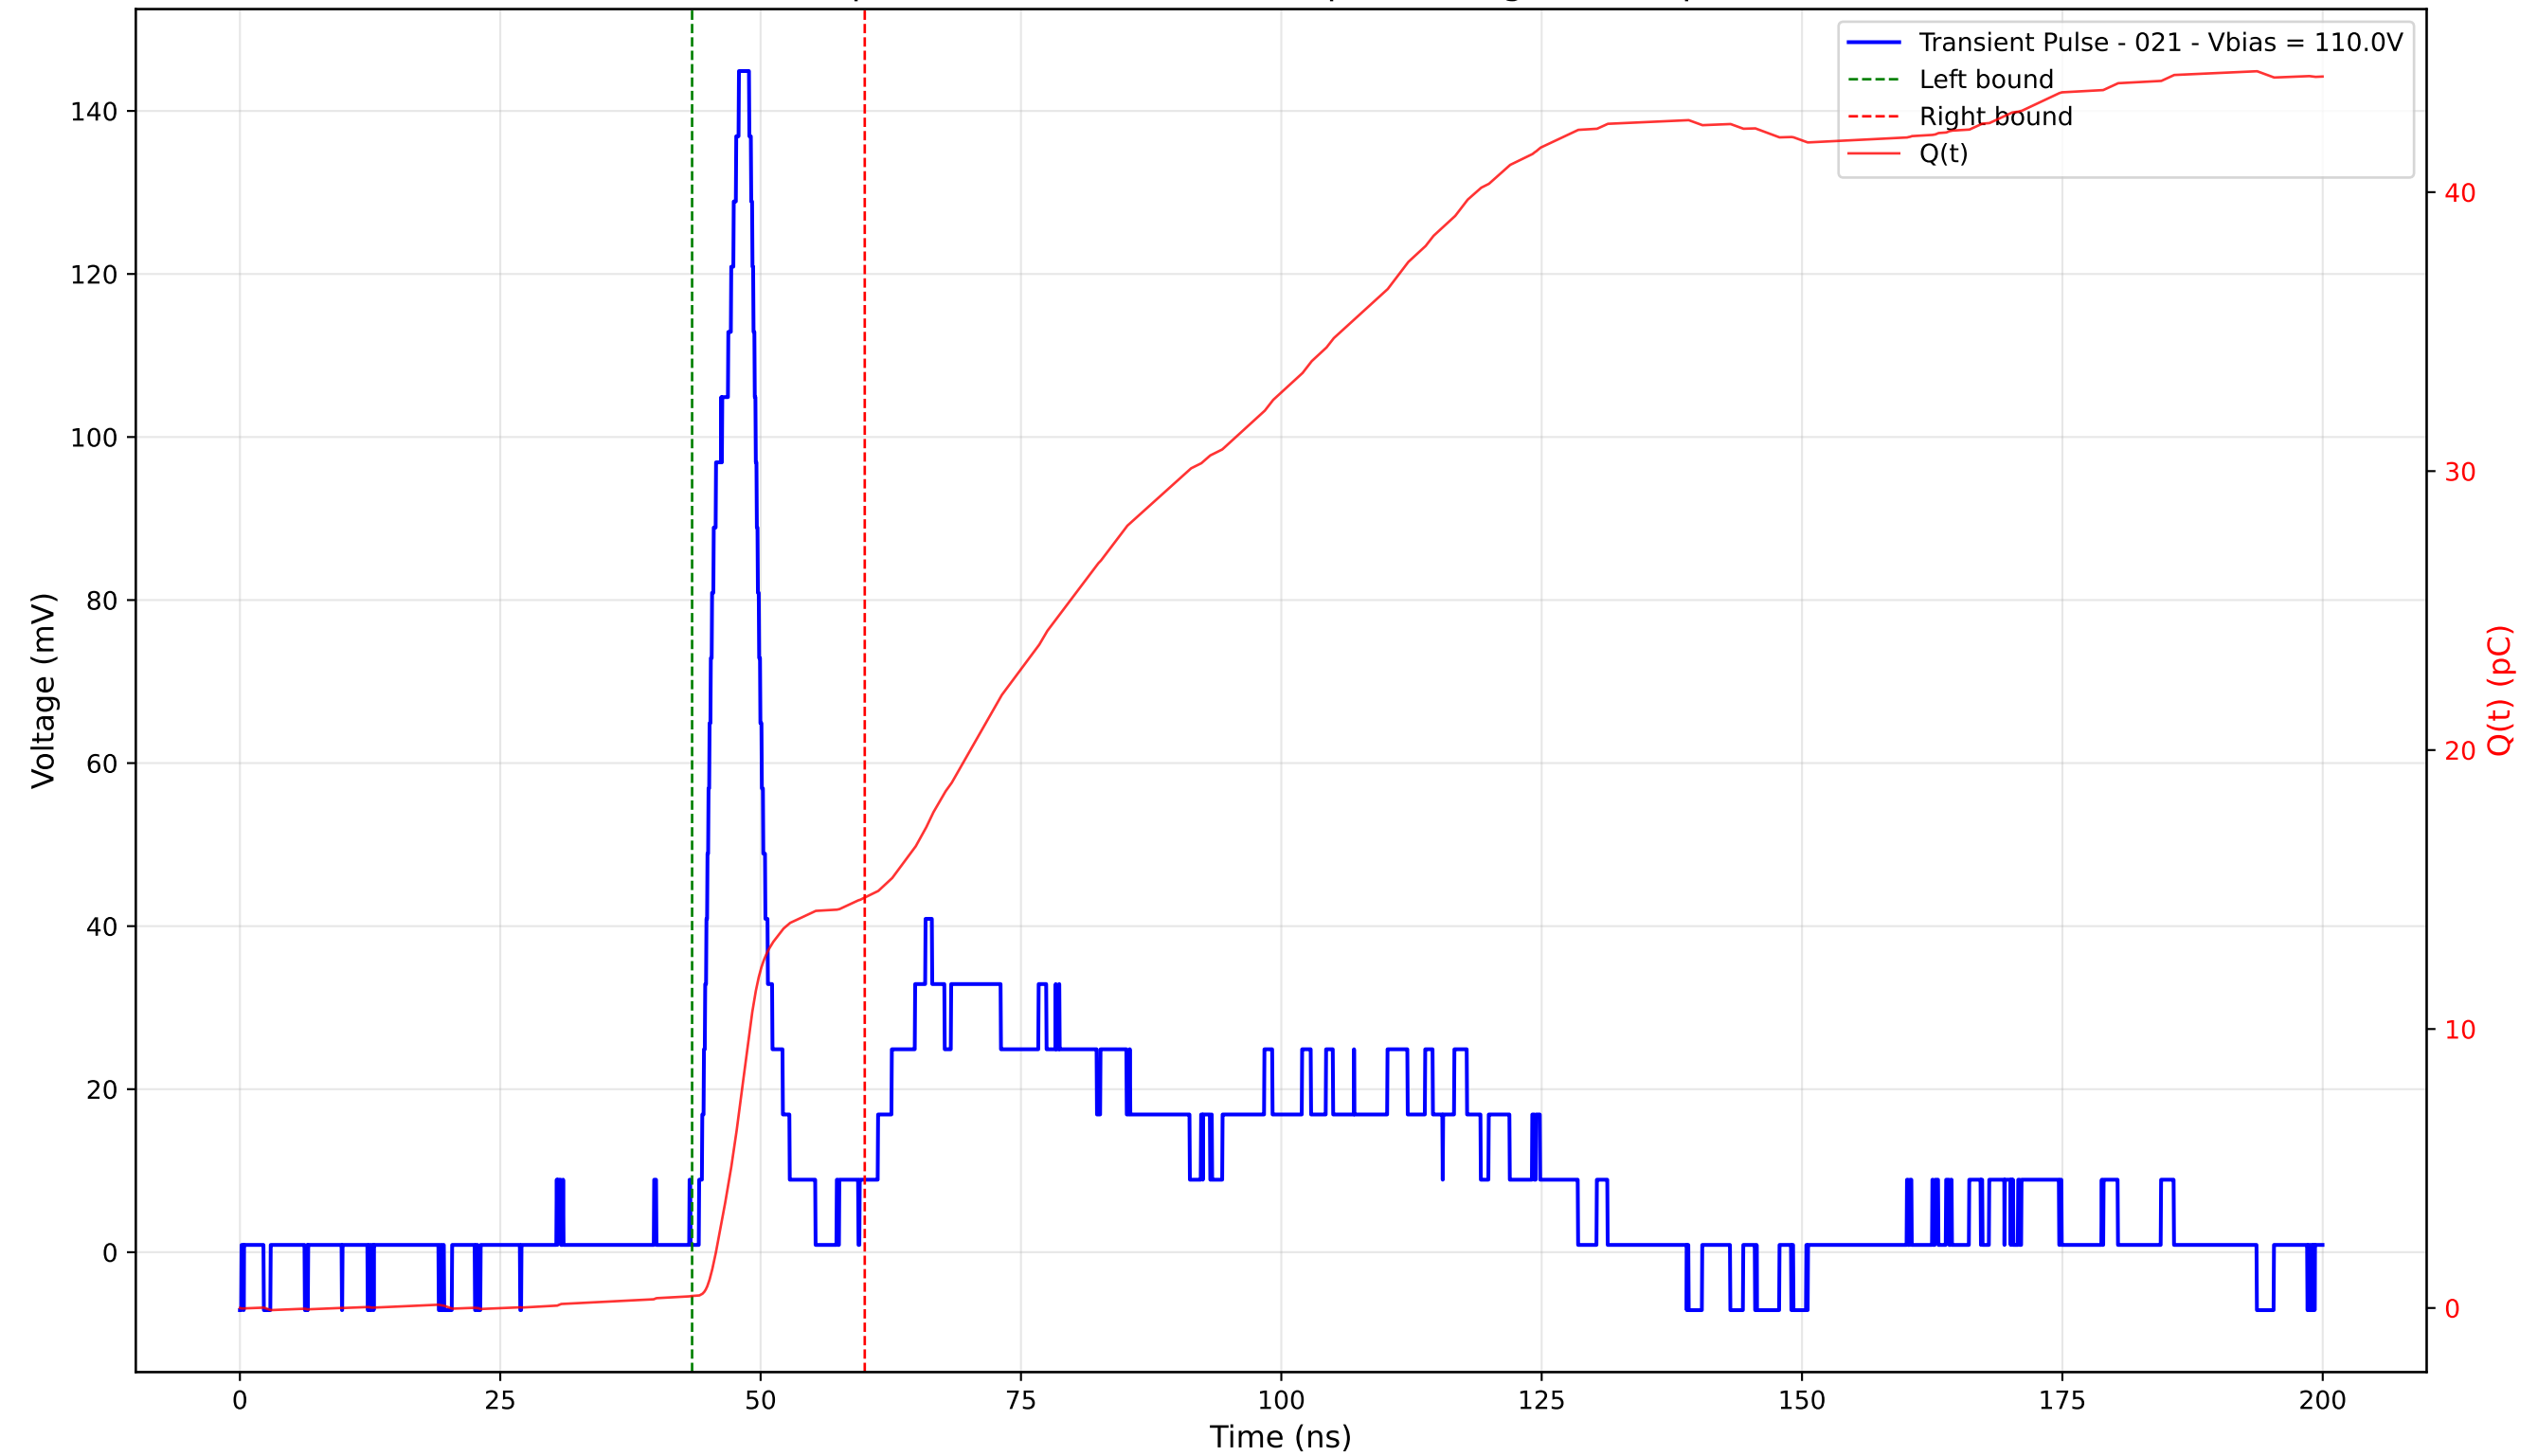


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 13.59 pC - Rise Time: 3.53 ns

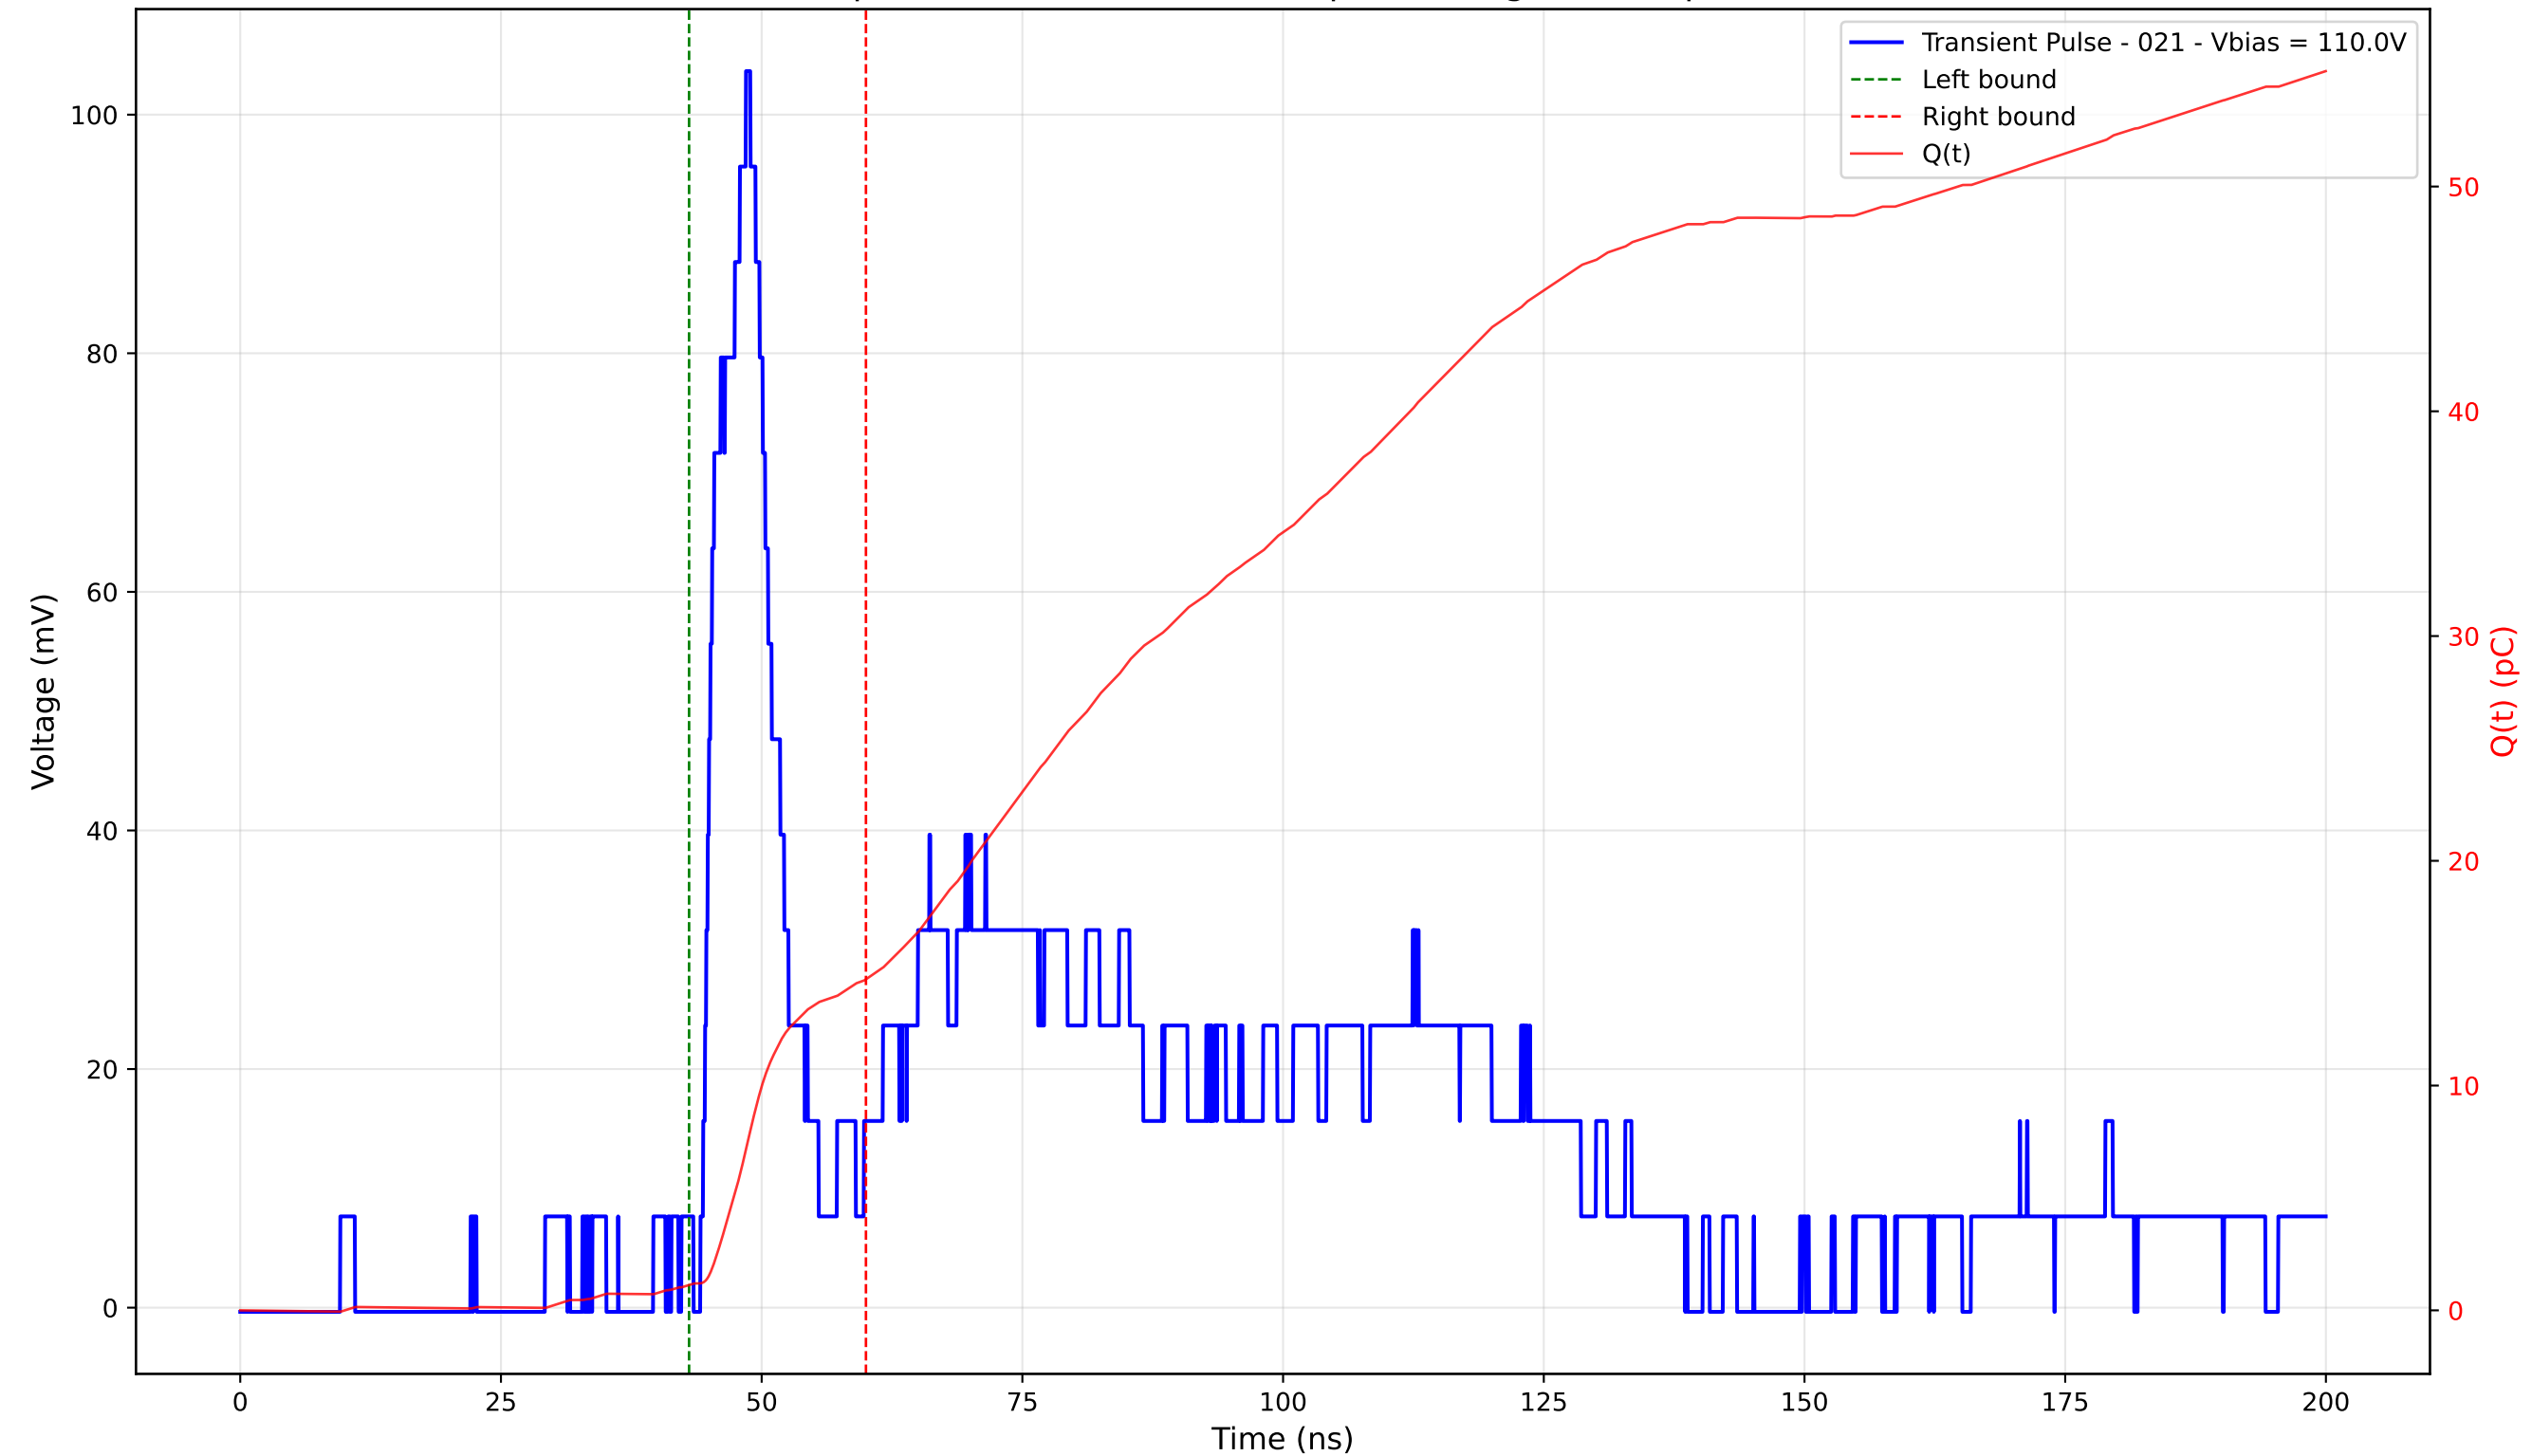


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 10.68 pC - Rise Time: 4.29 ns

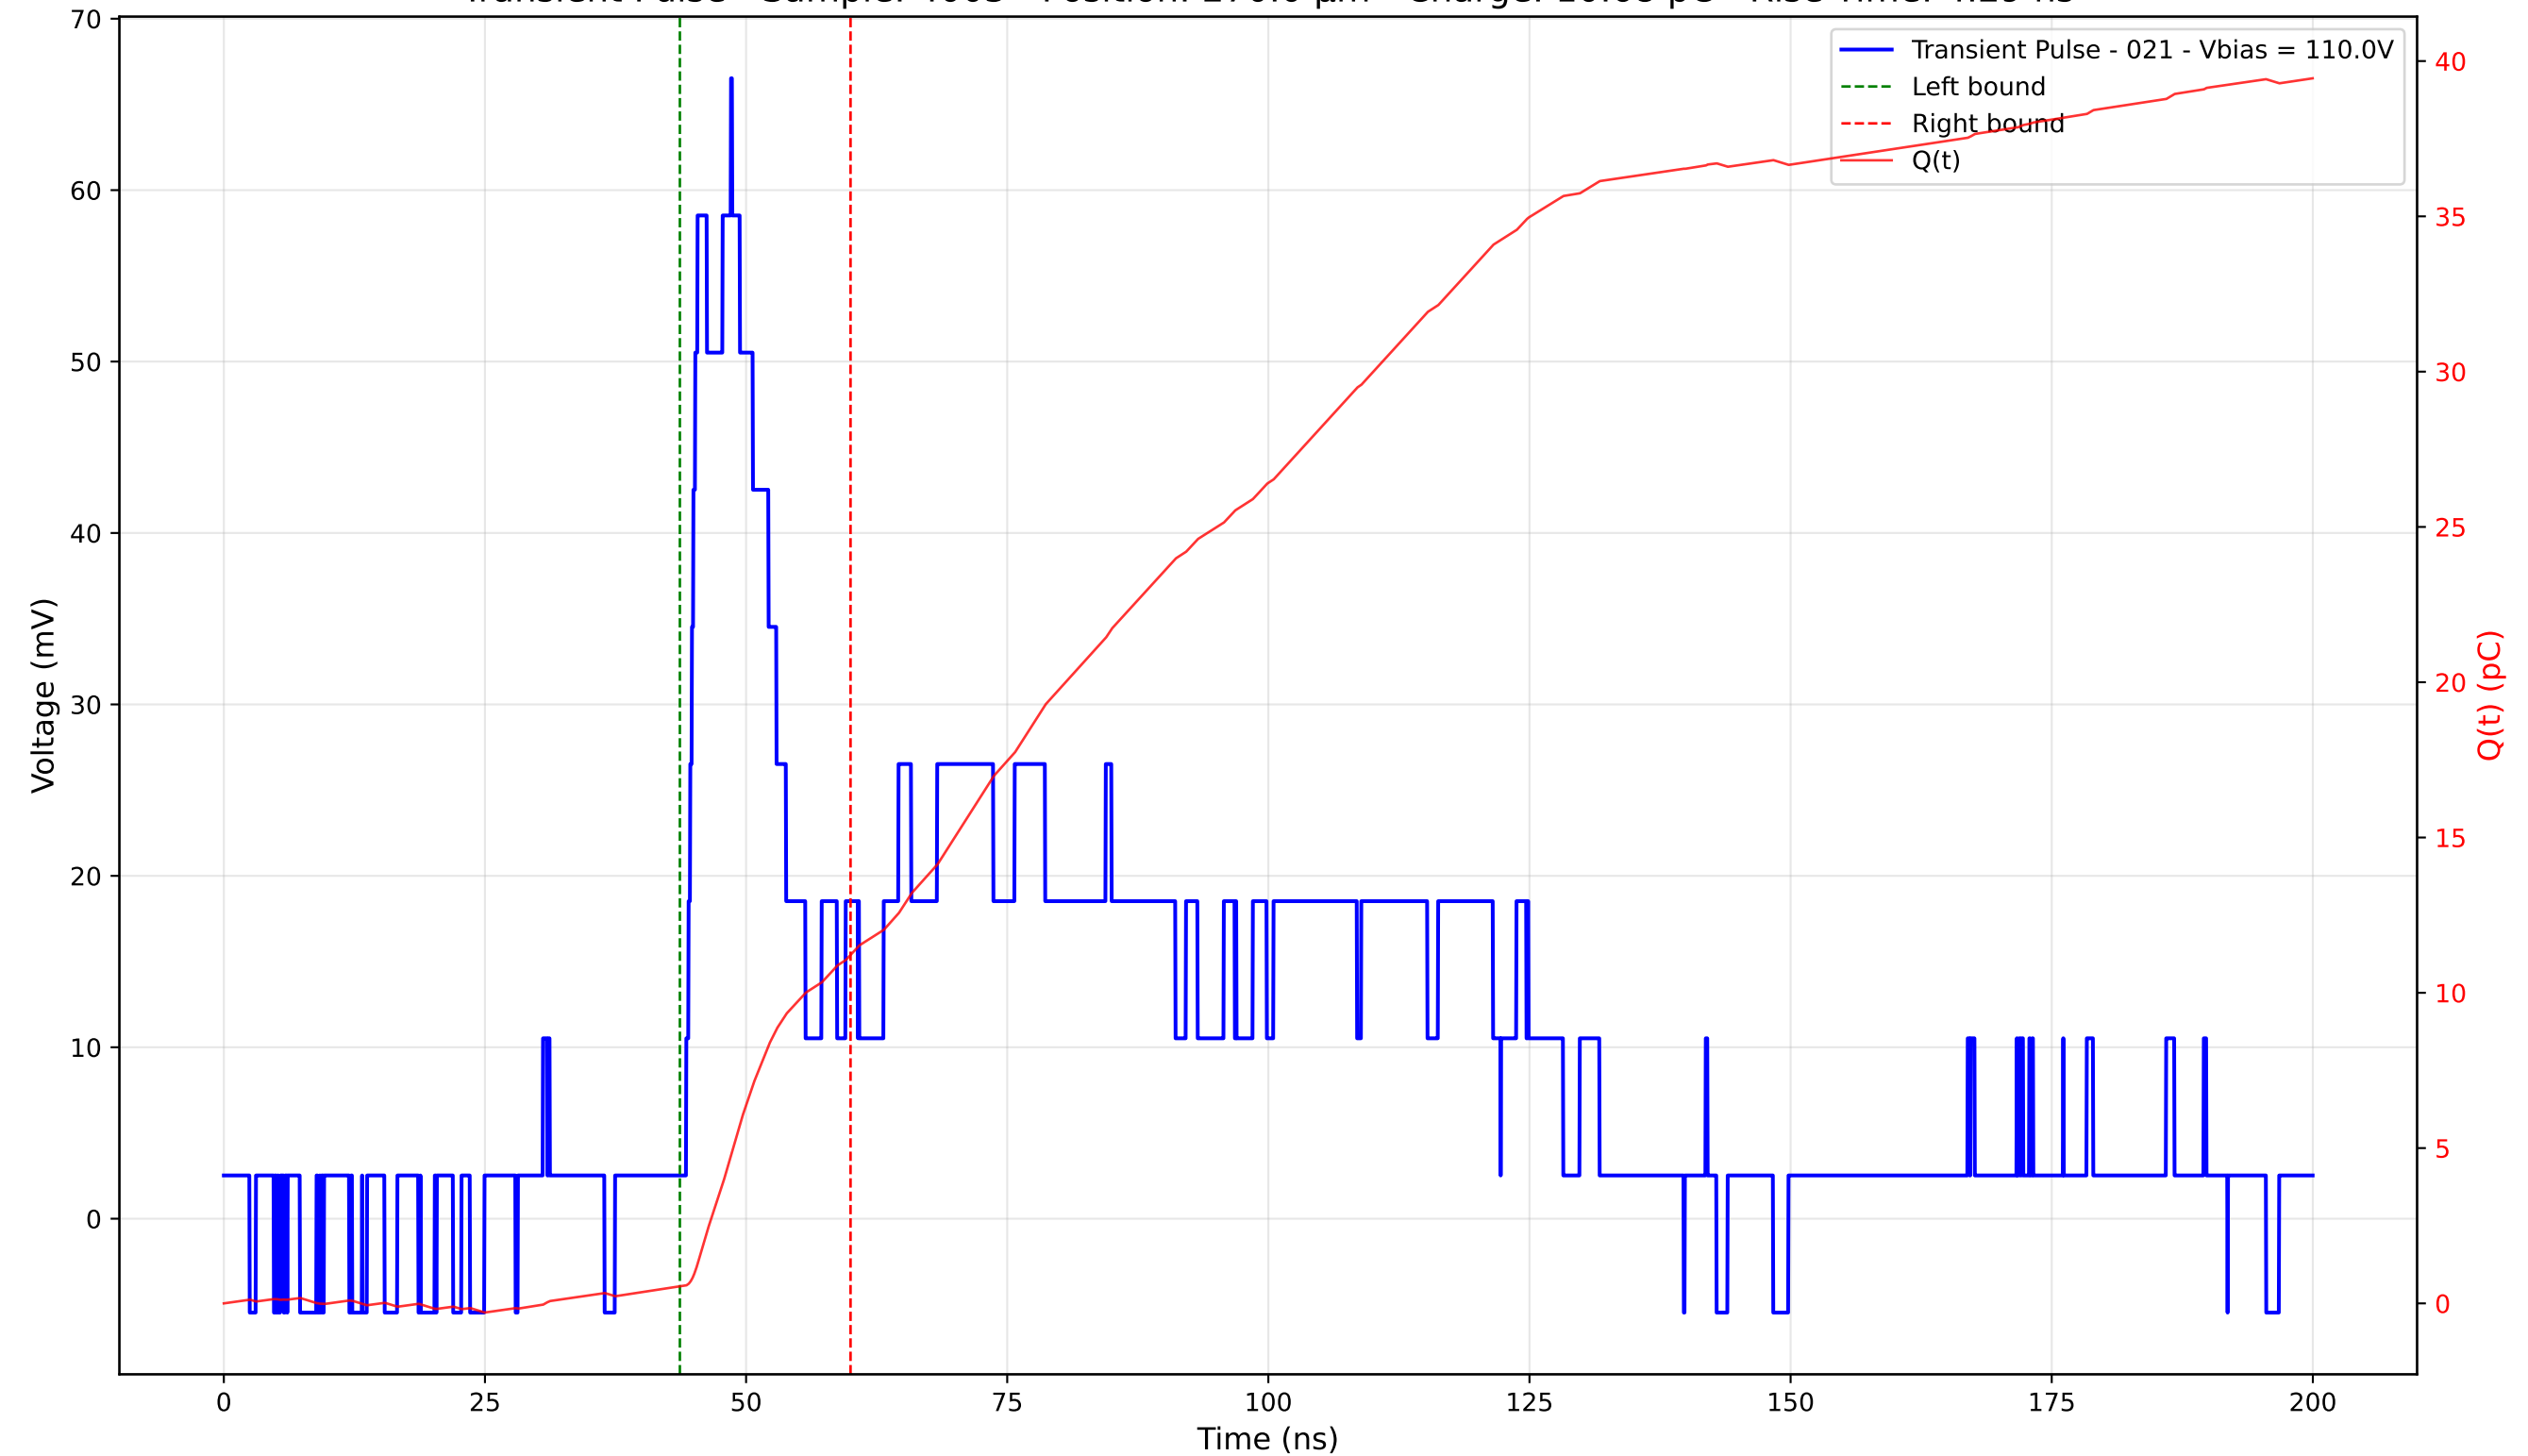


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 8.08 pC - Rise Time: 1.00 ns

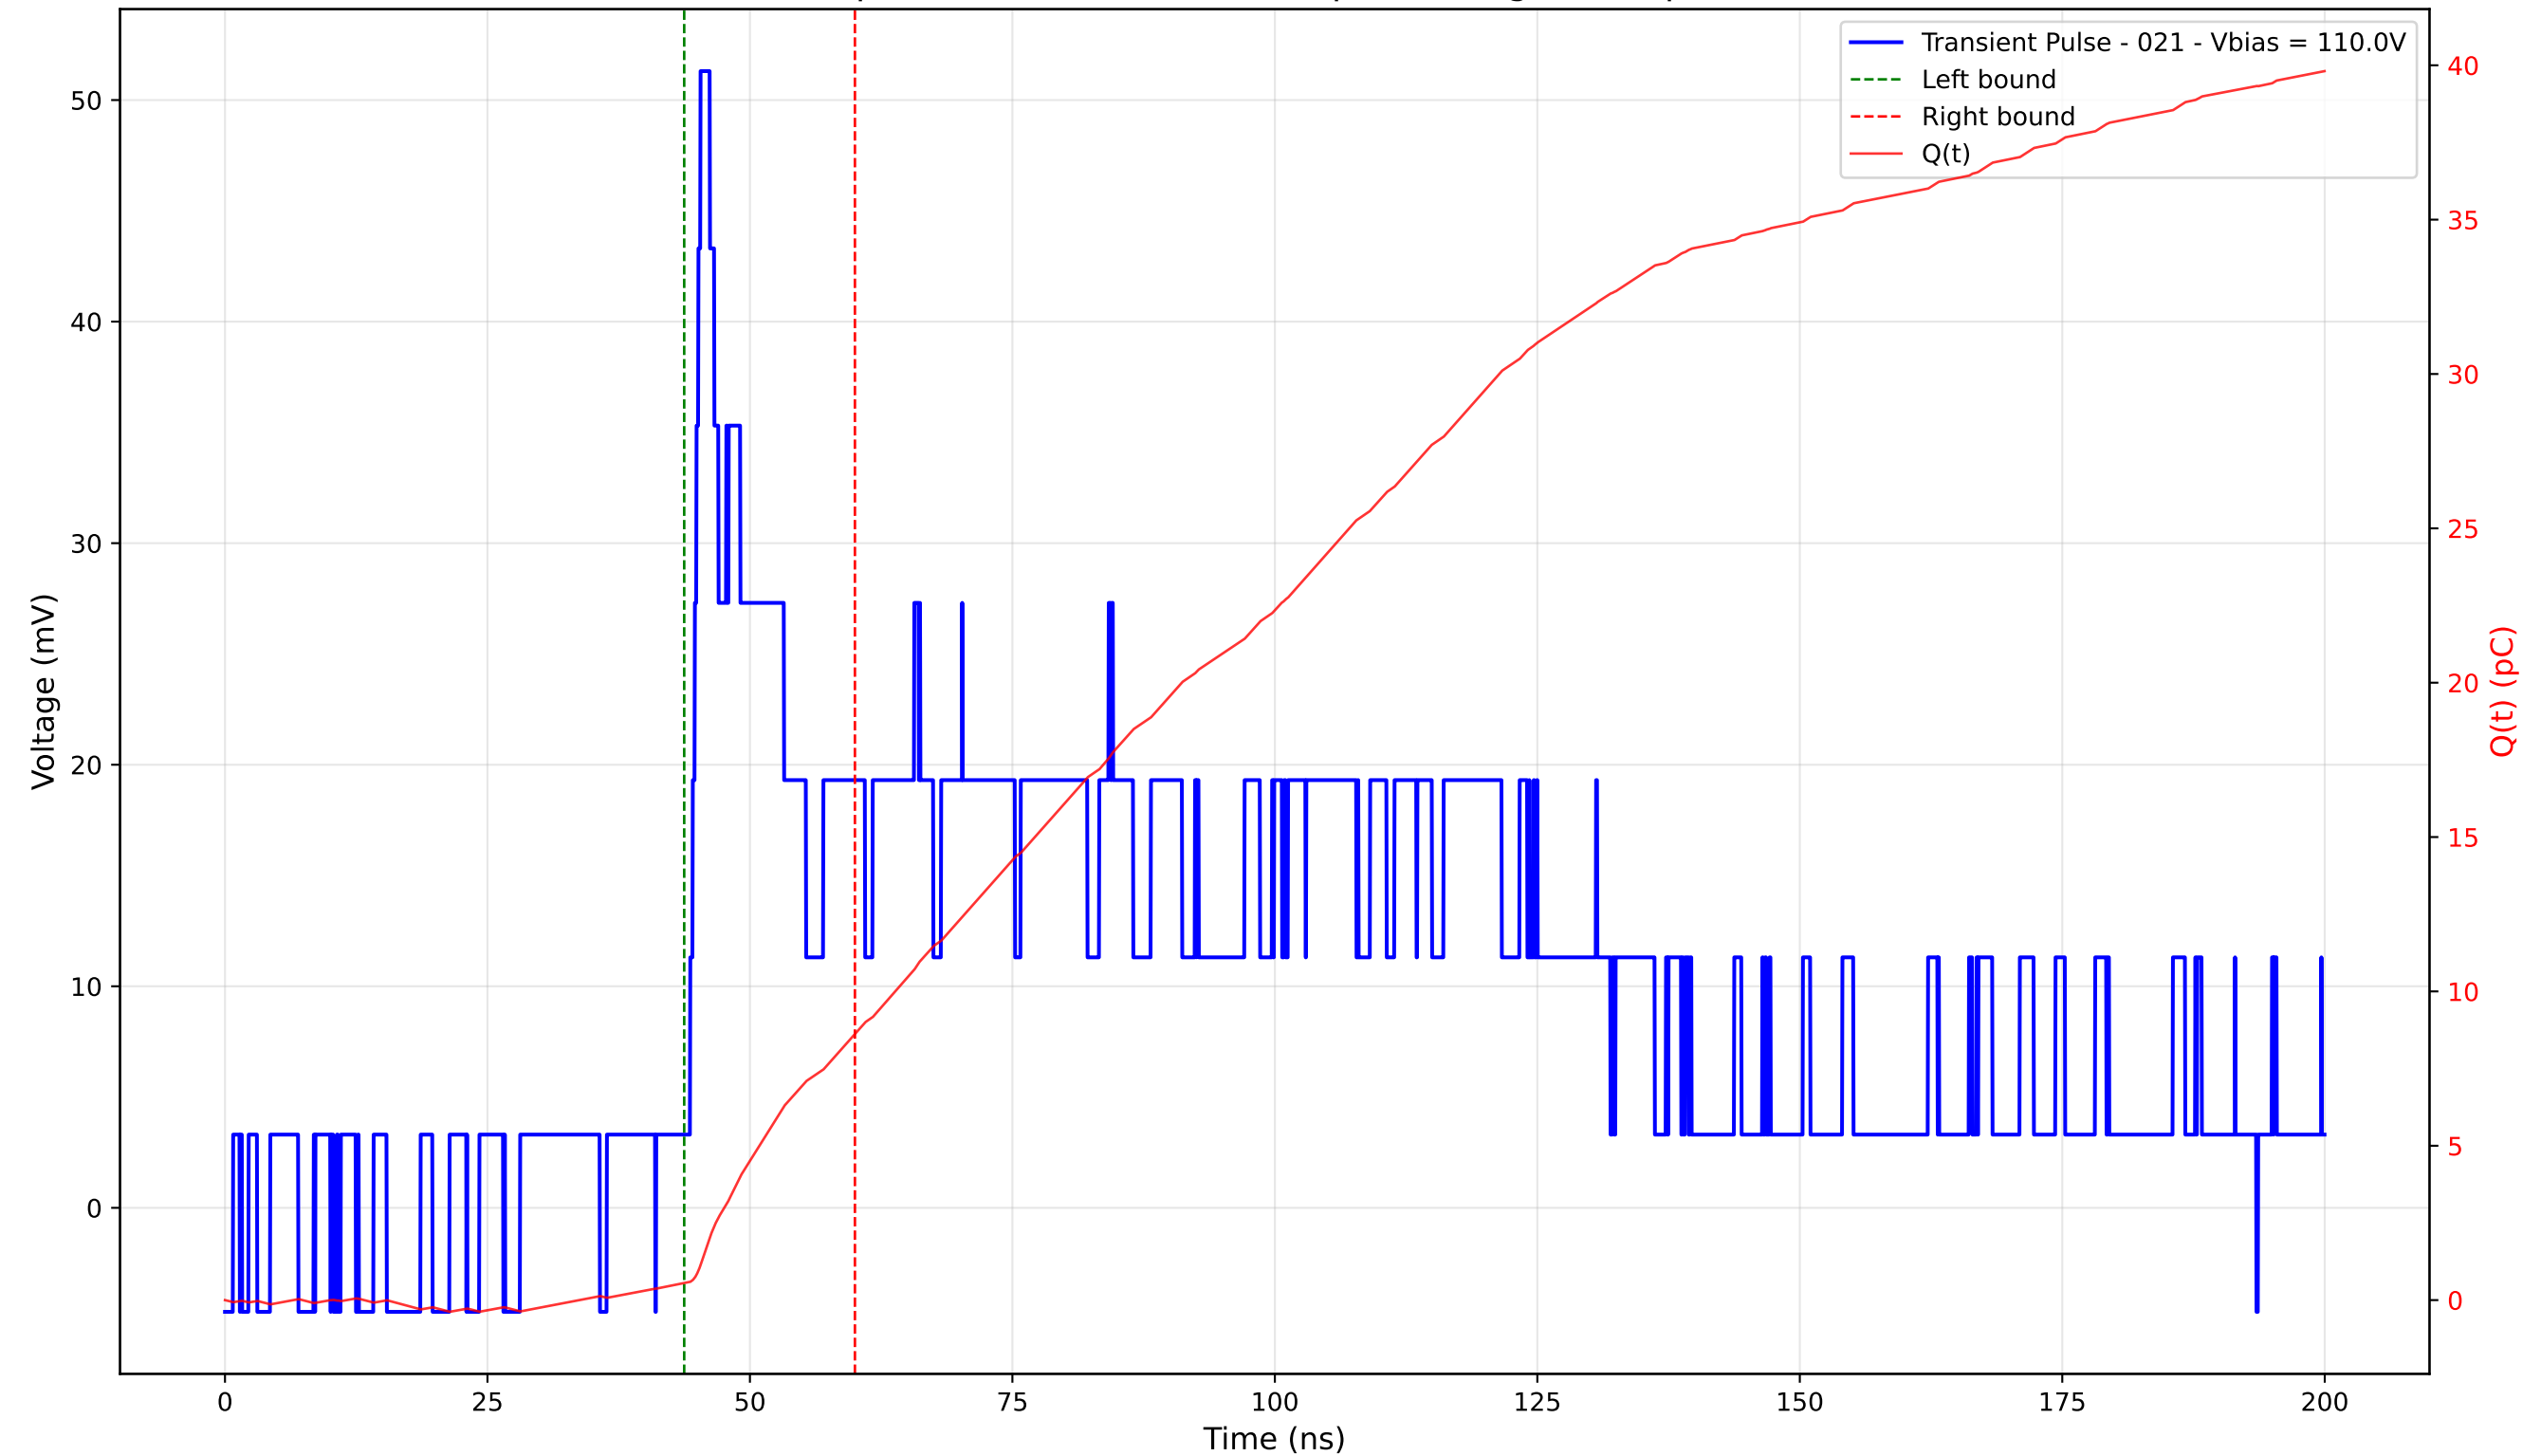


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 5.51 pC - Rise Time: 0.99 ns

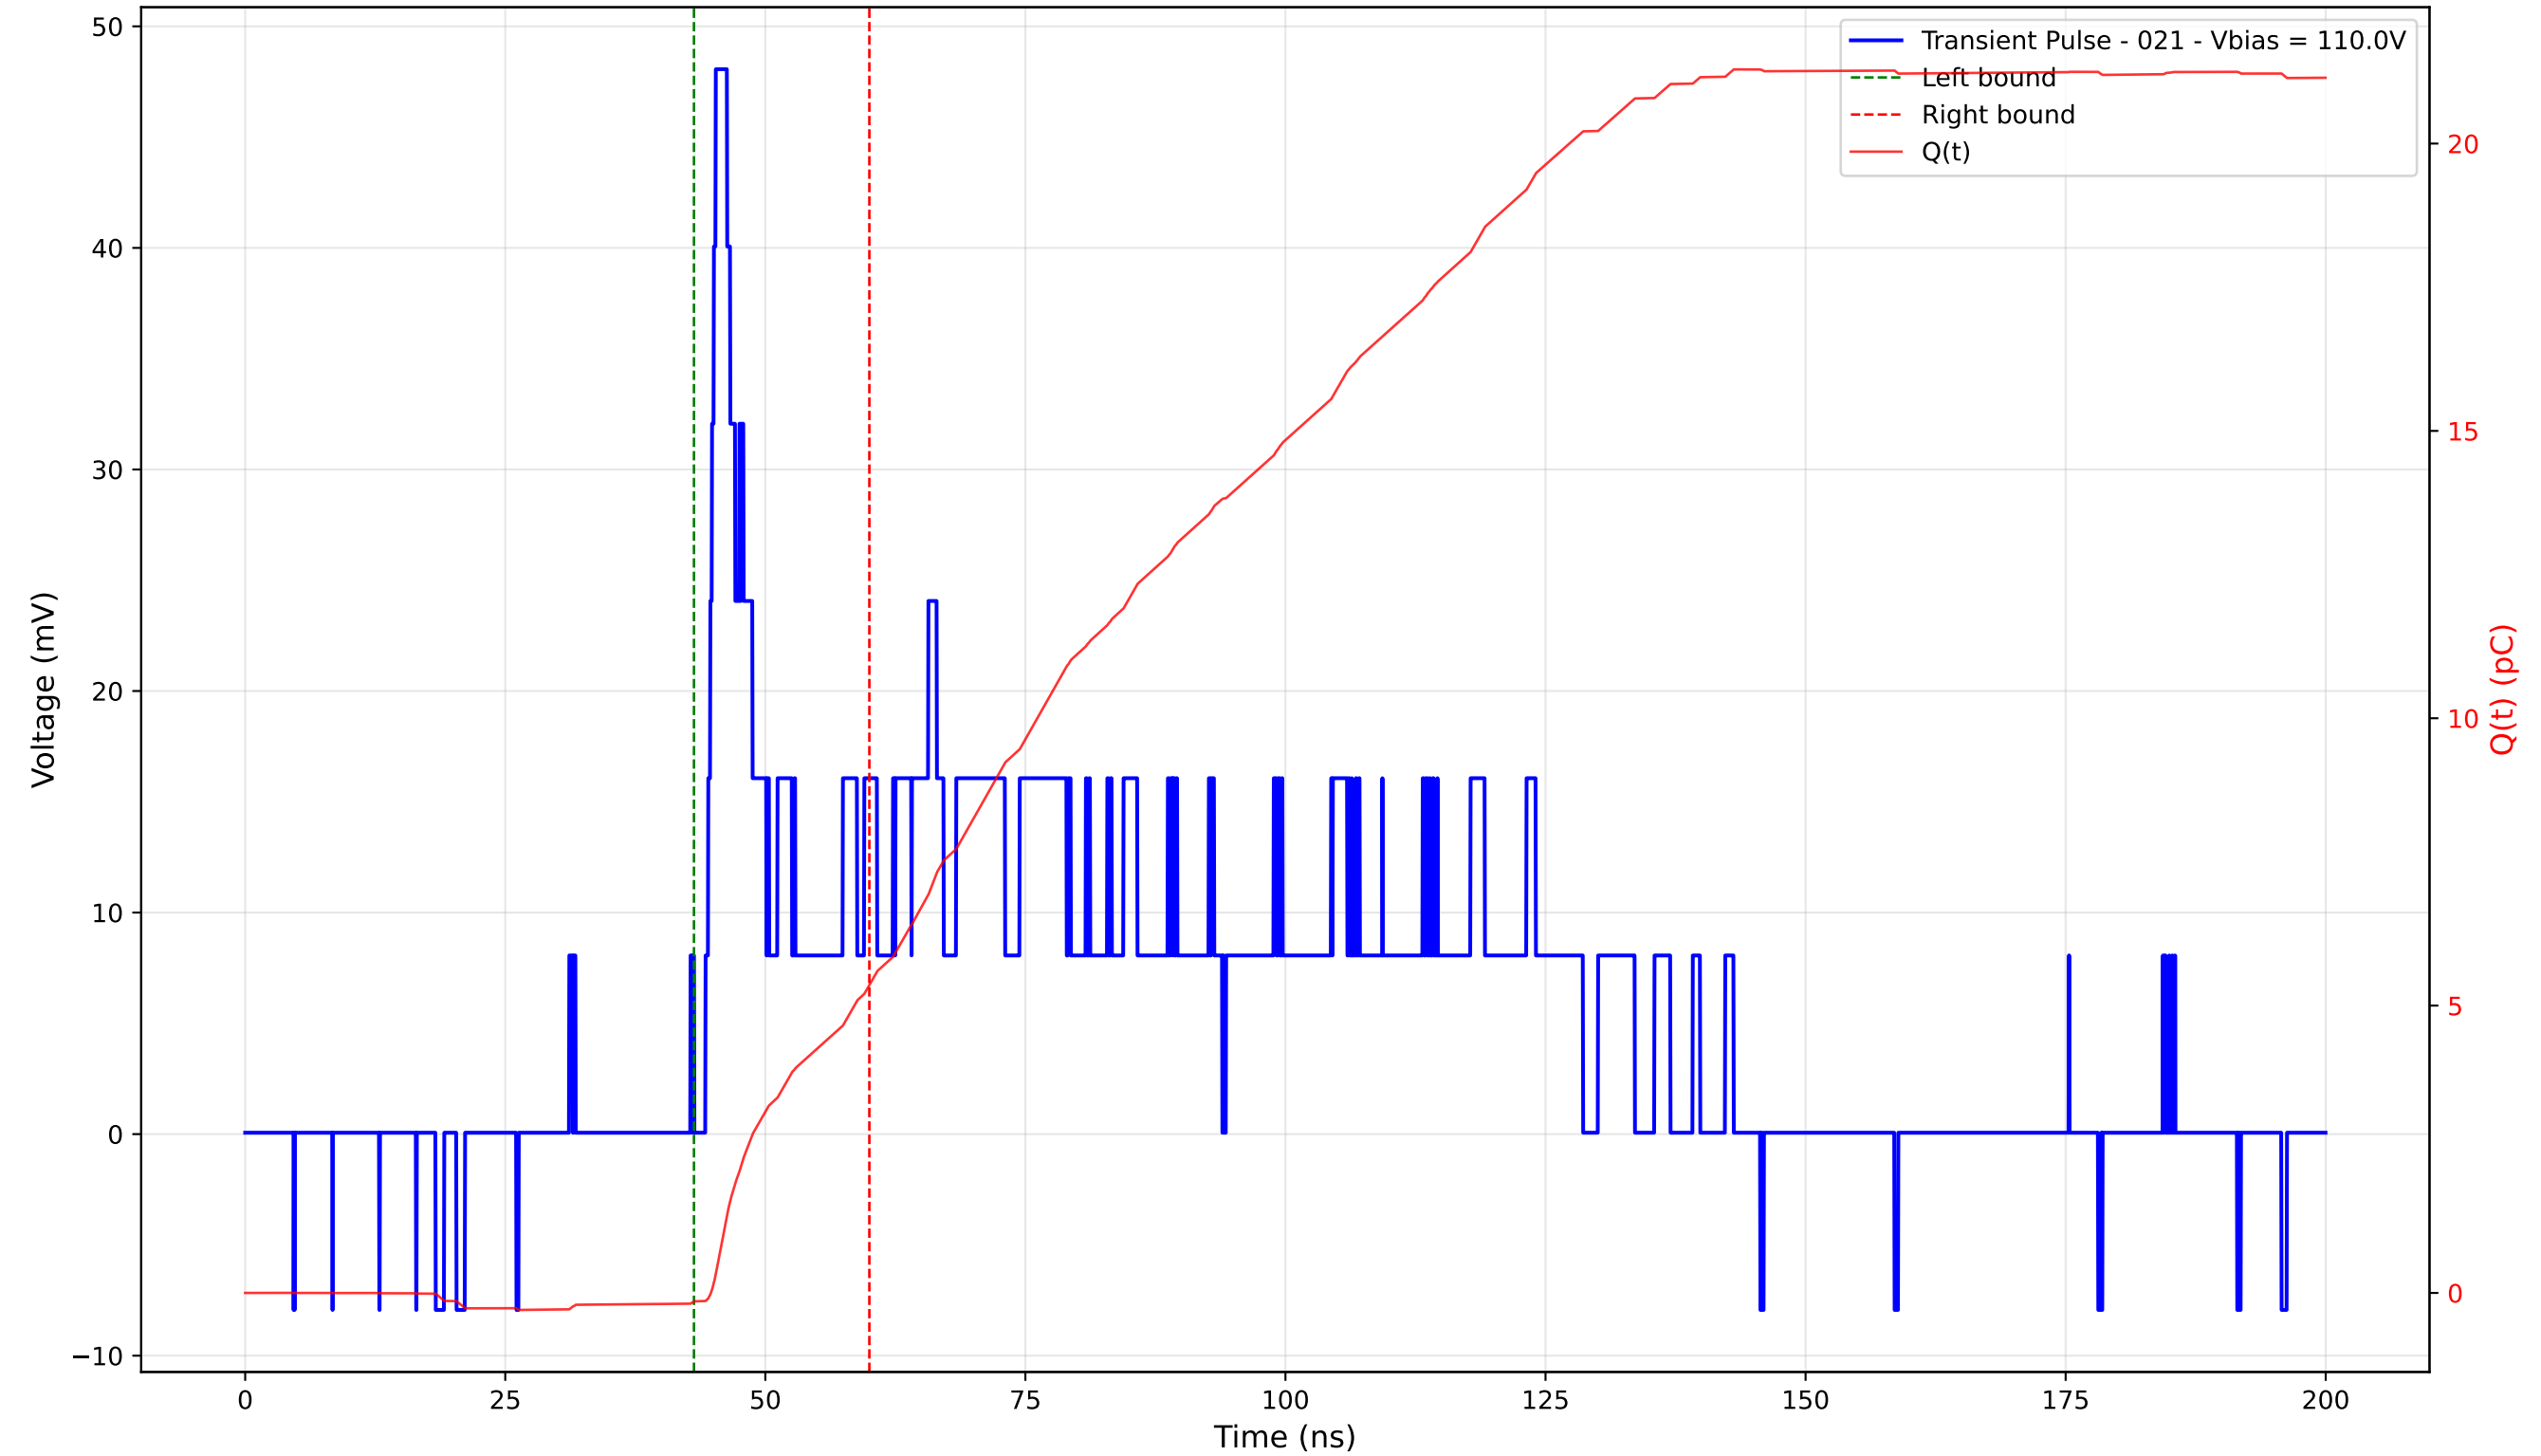


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 4.98 pC - Rise Time: 1.47 ns

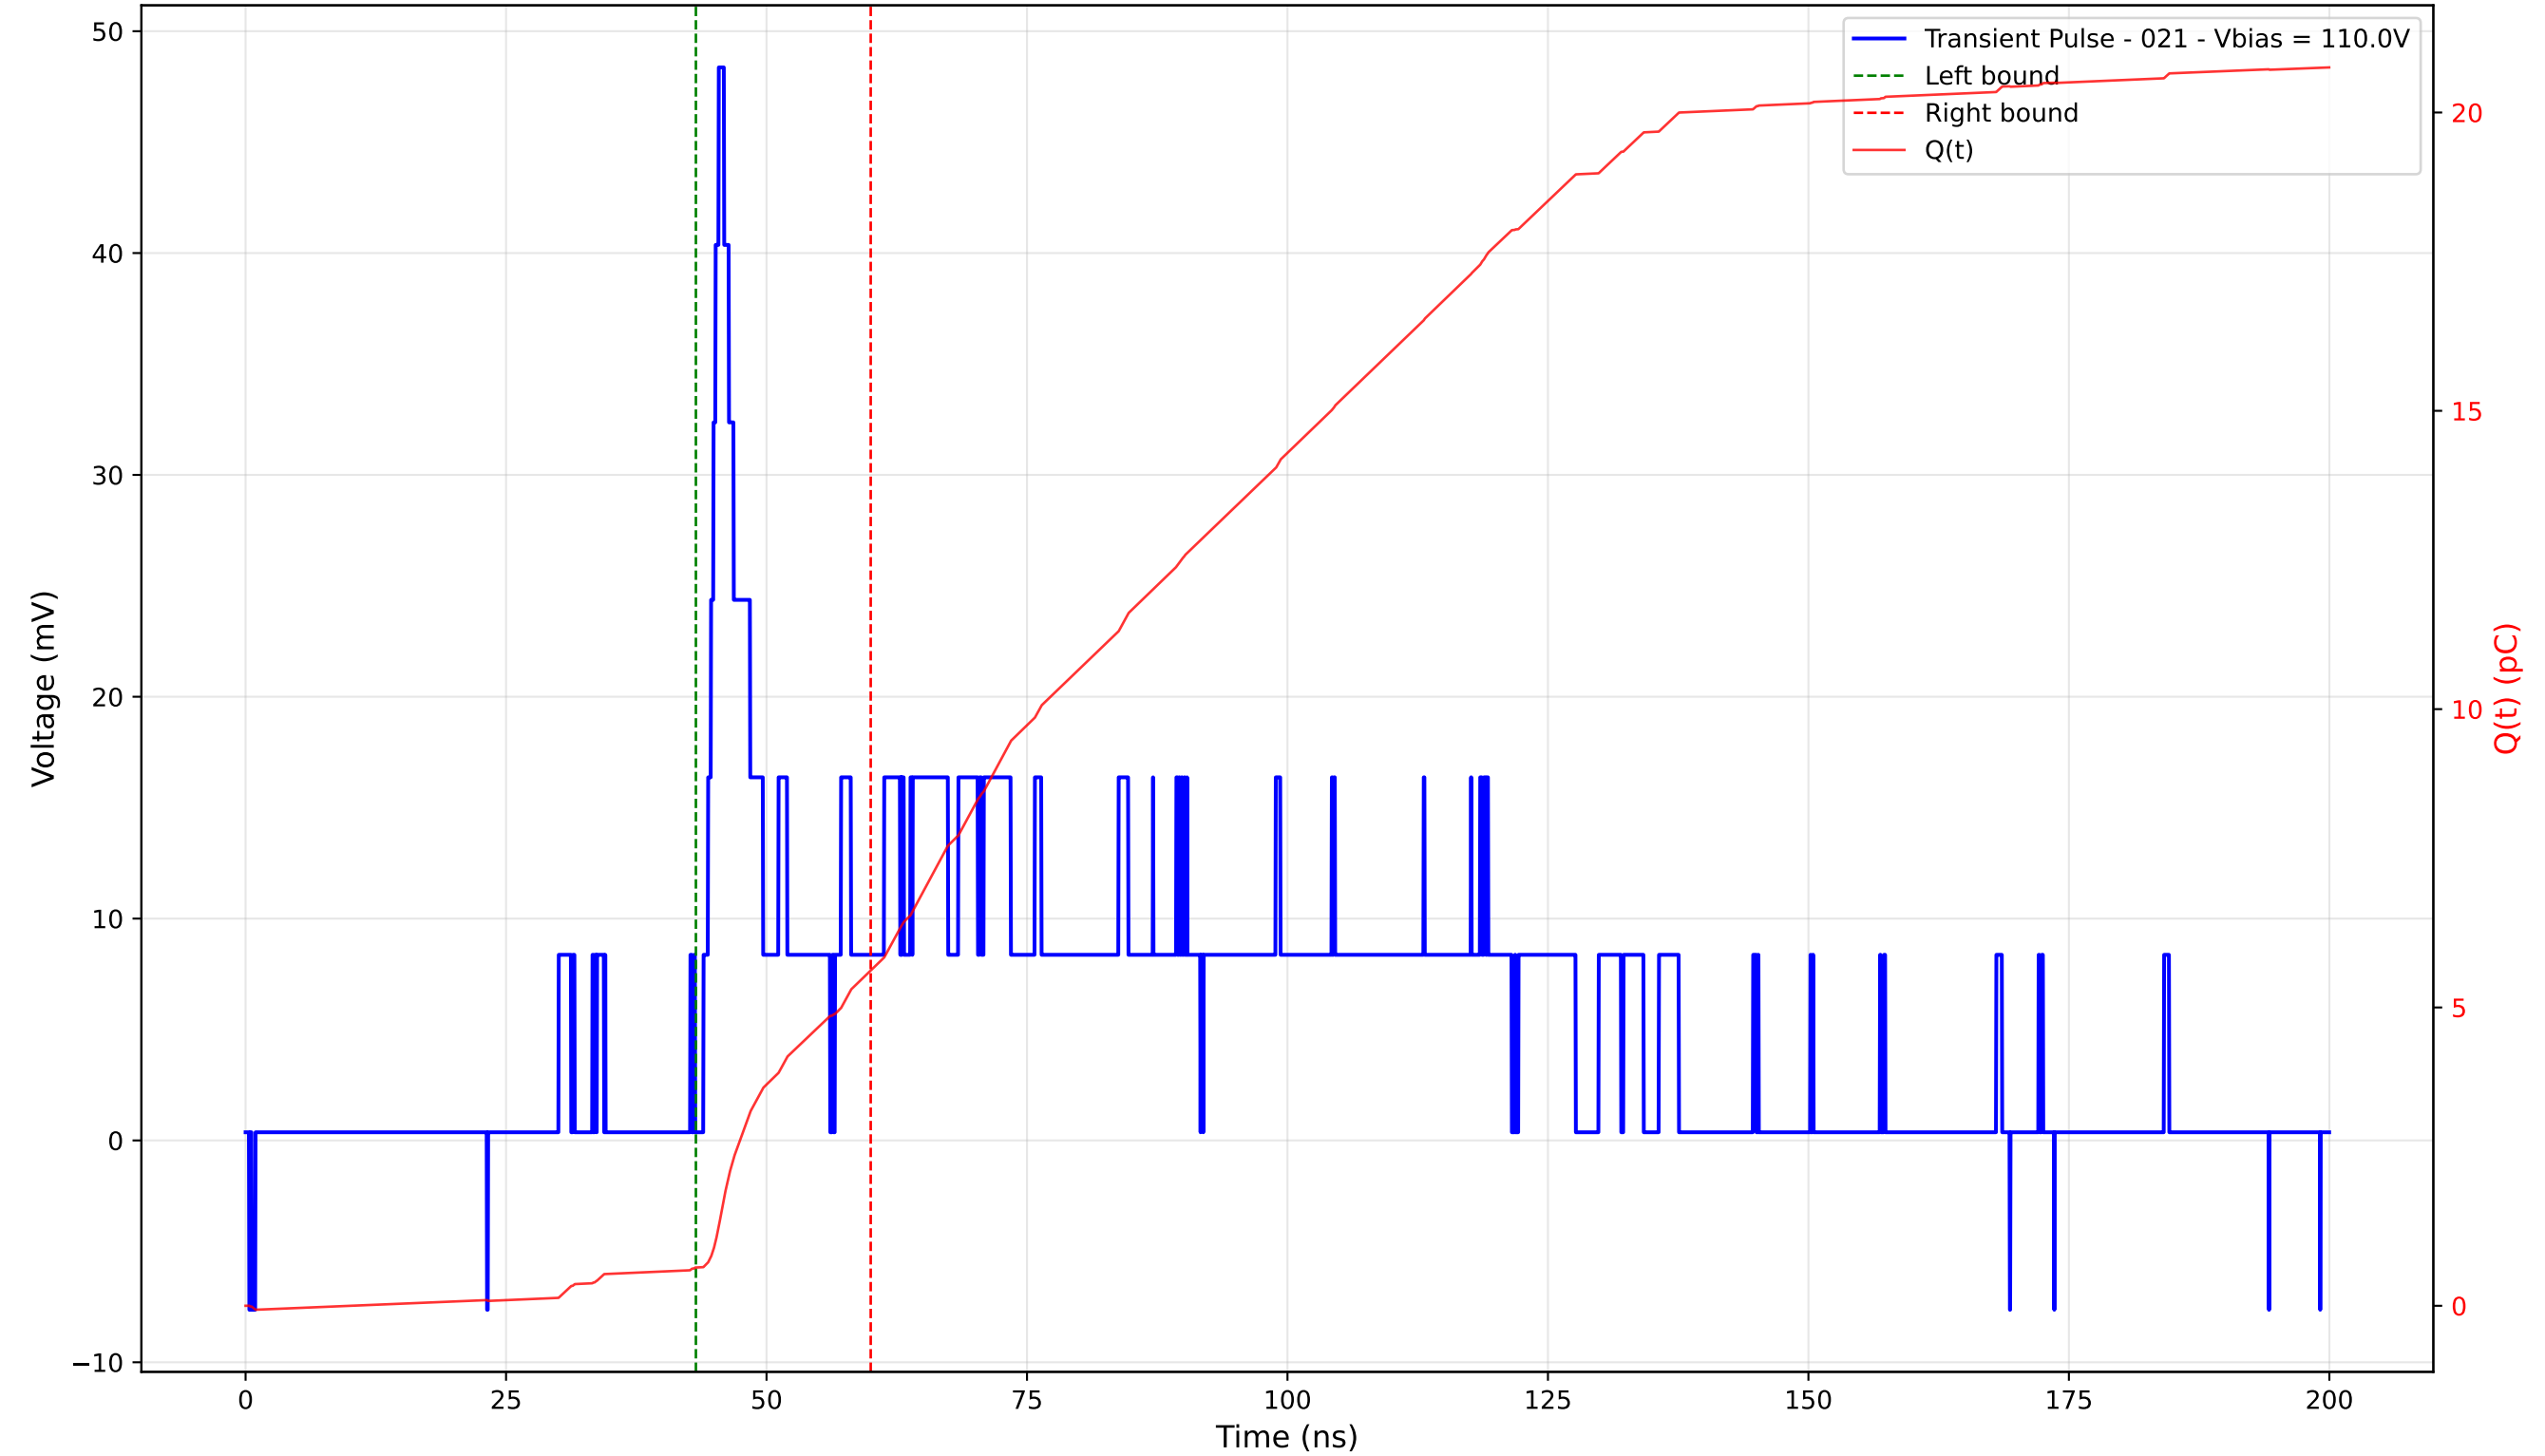


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 3.81 pC - Rise Time: 1.01 ns

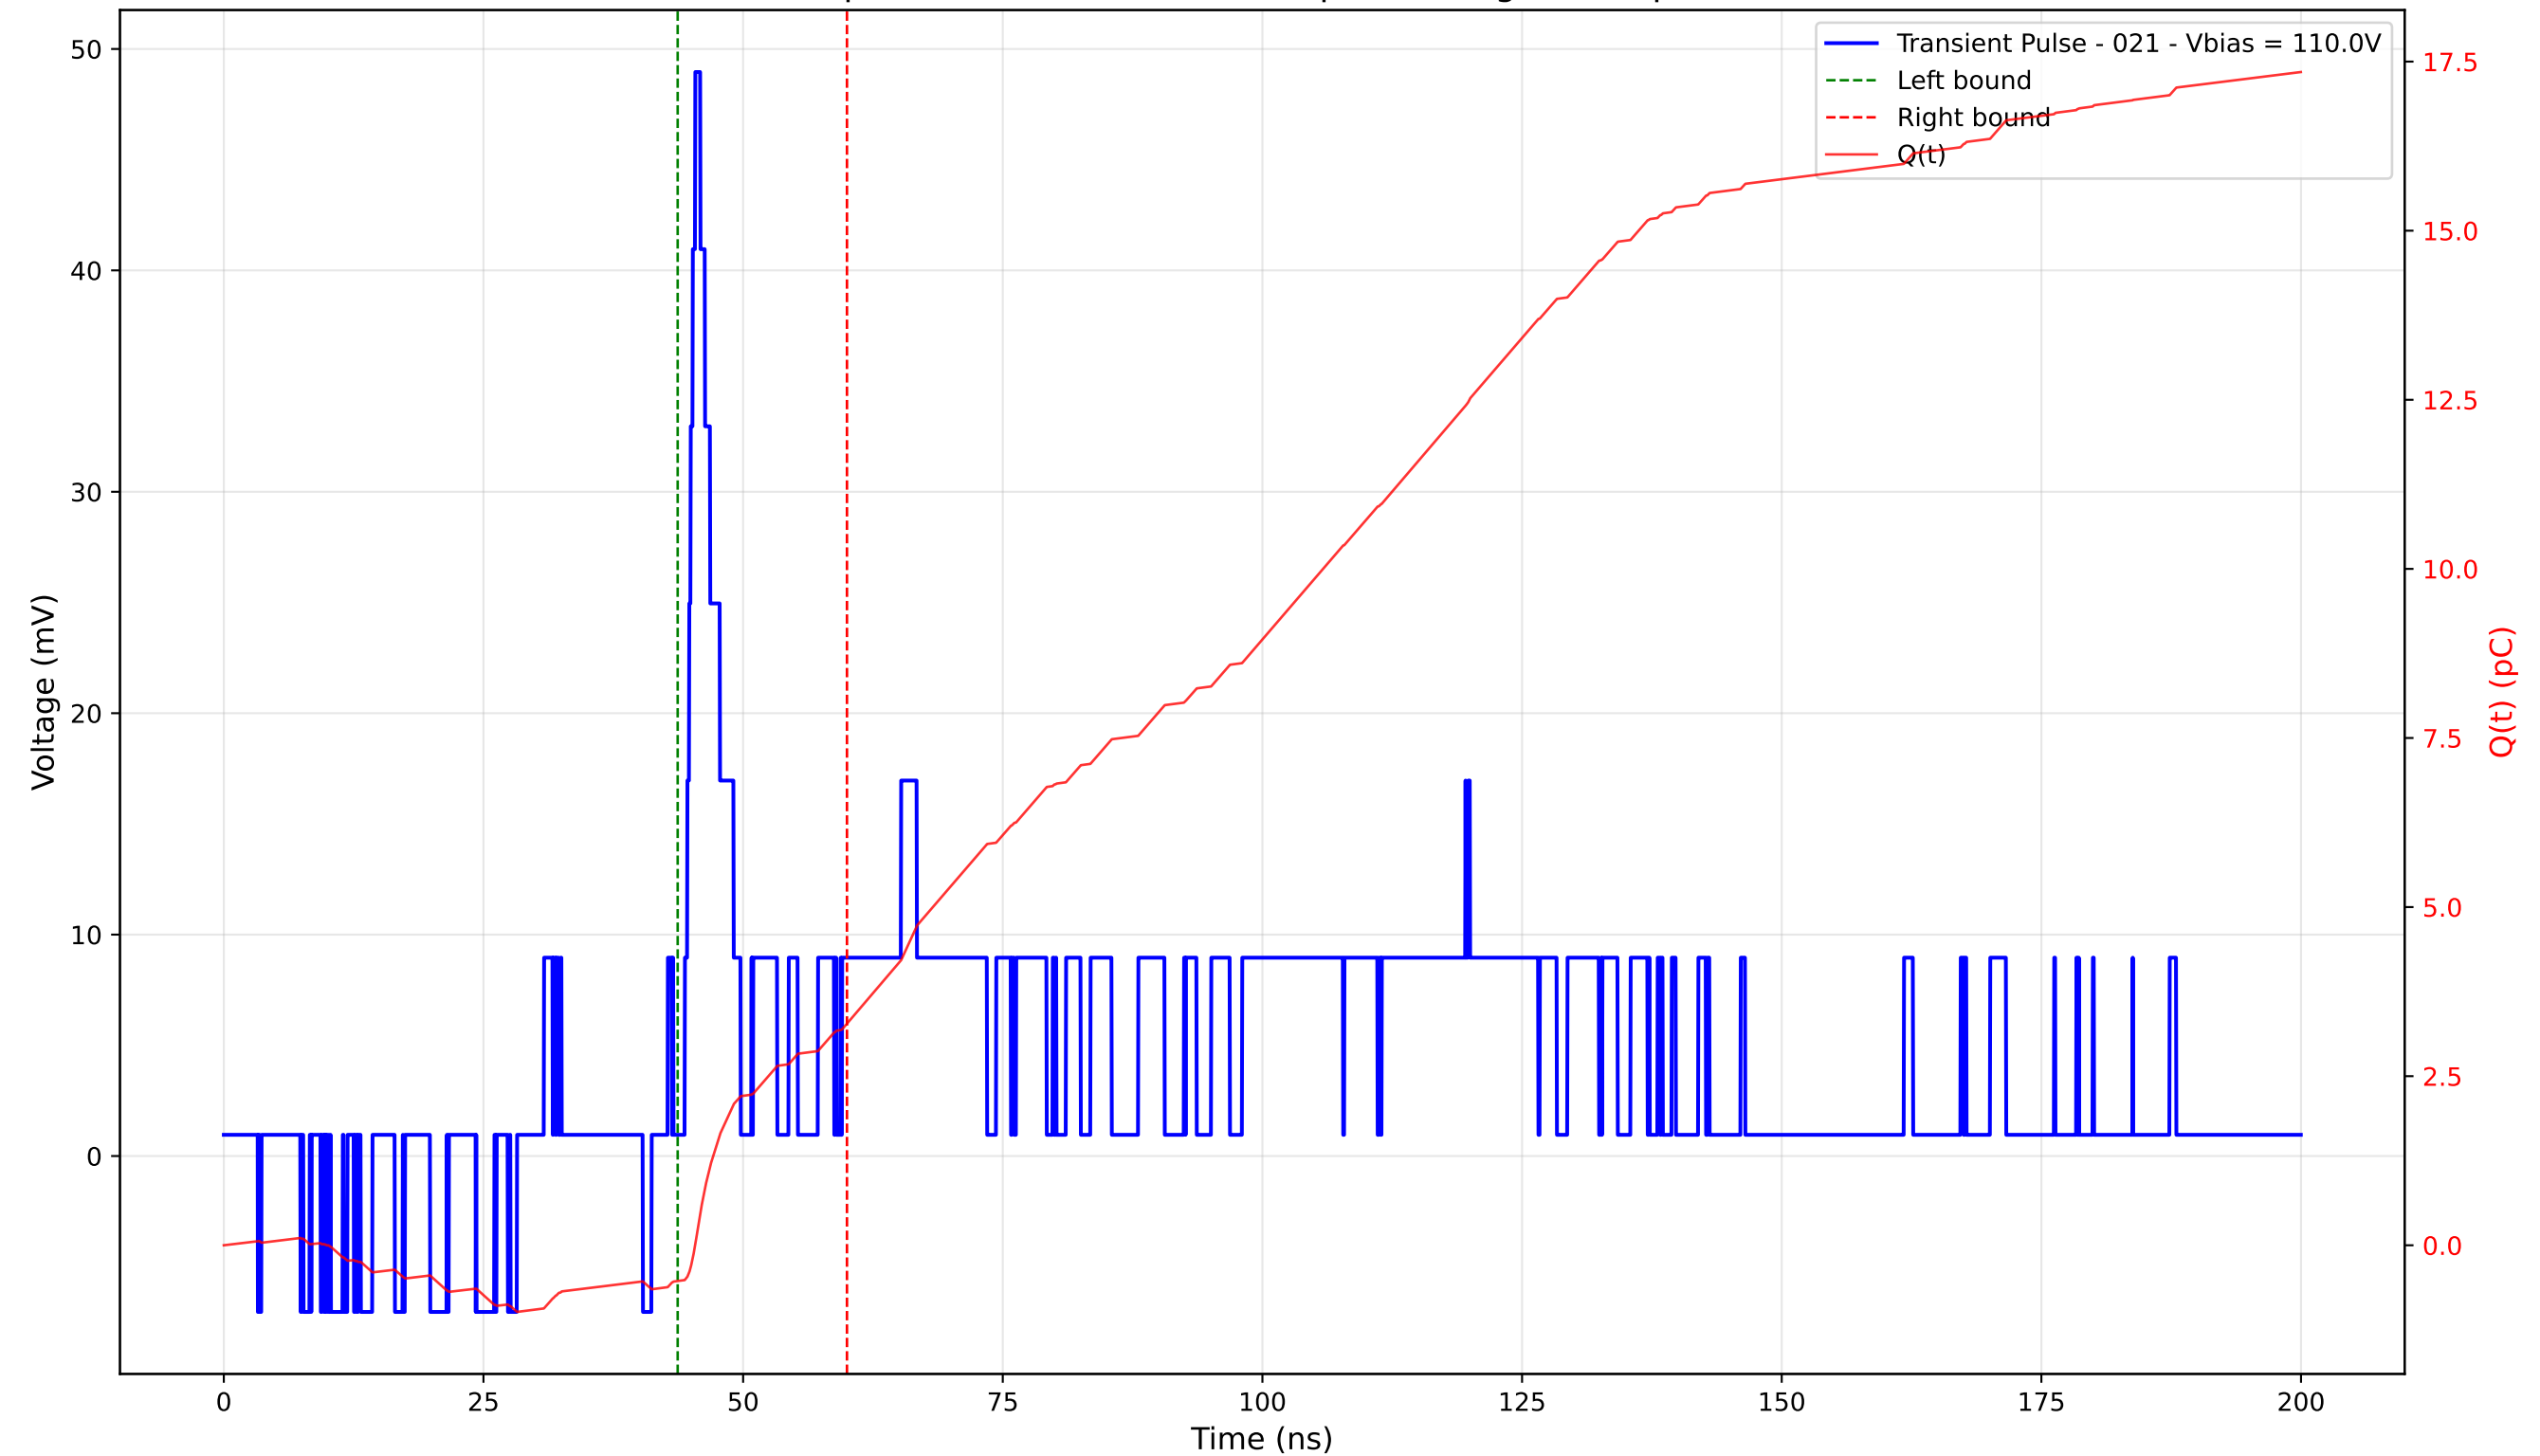


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 3.96 pC - Rise Time: 0.96 ns

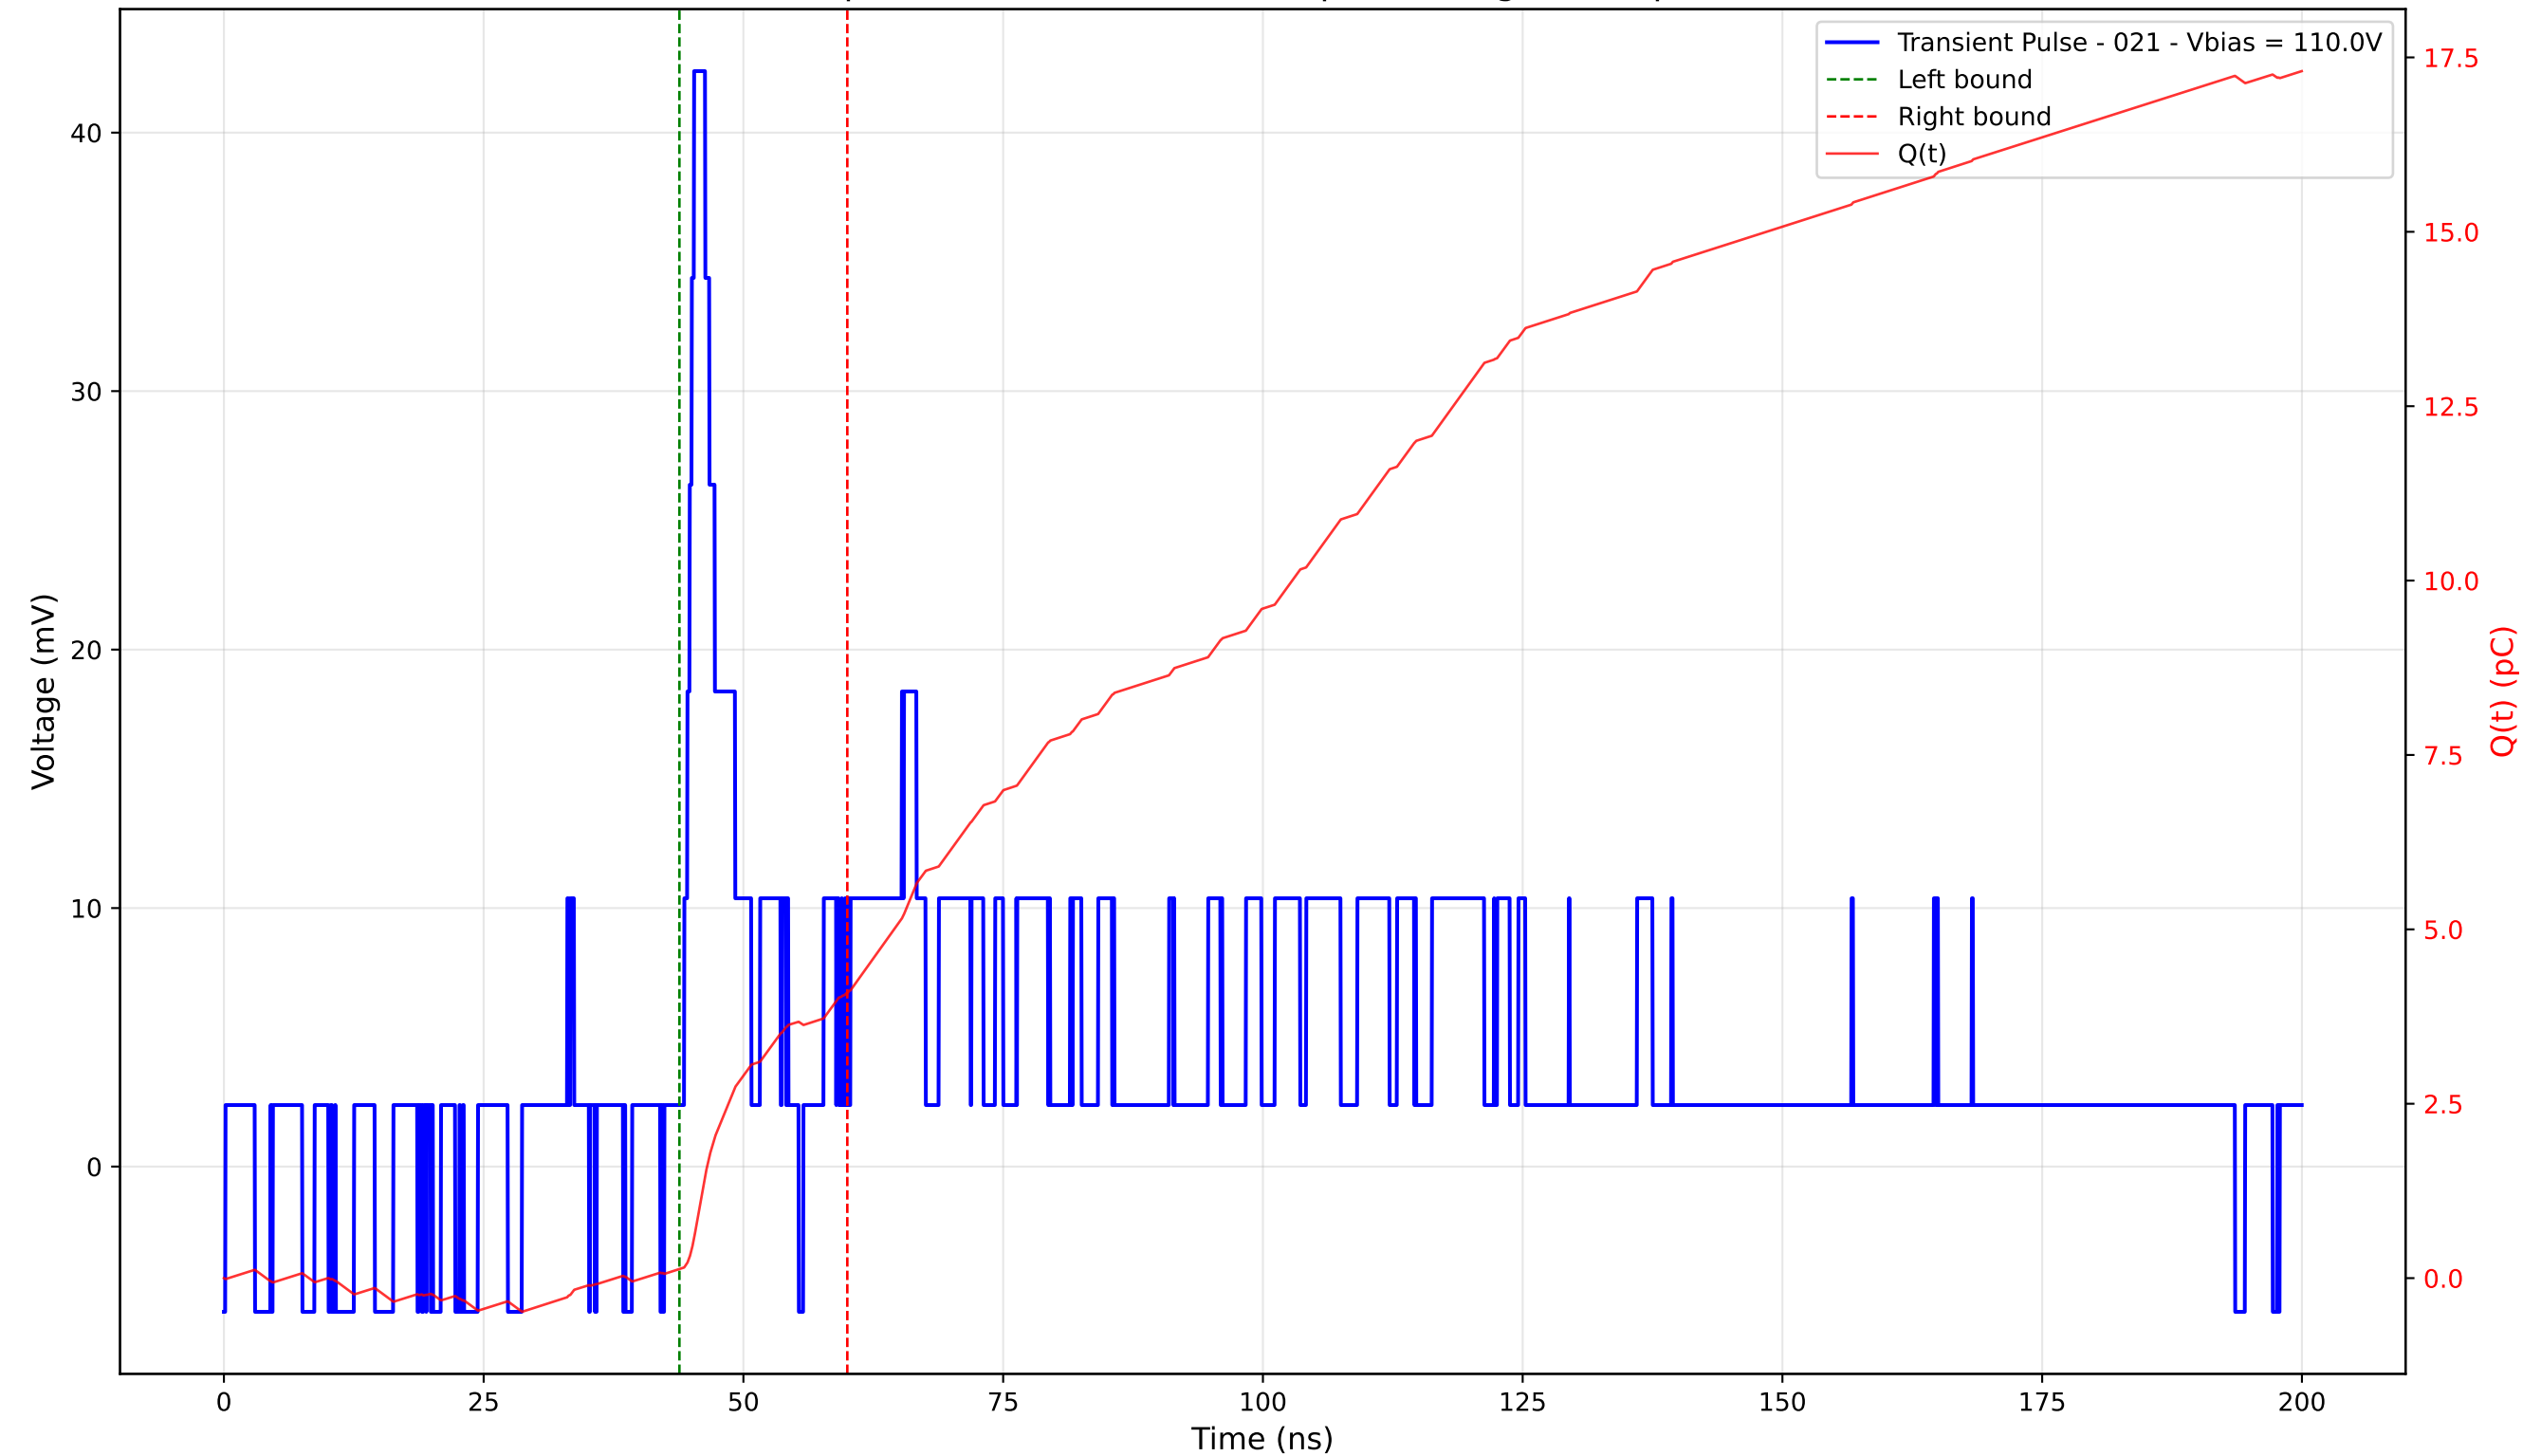


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 3.85 pC - Rise Time: 0.90 ns

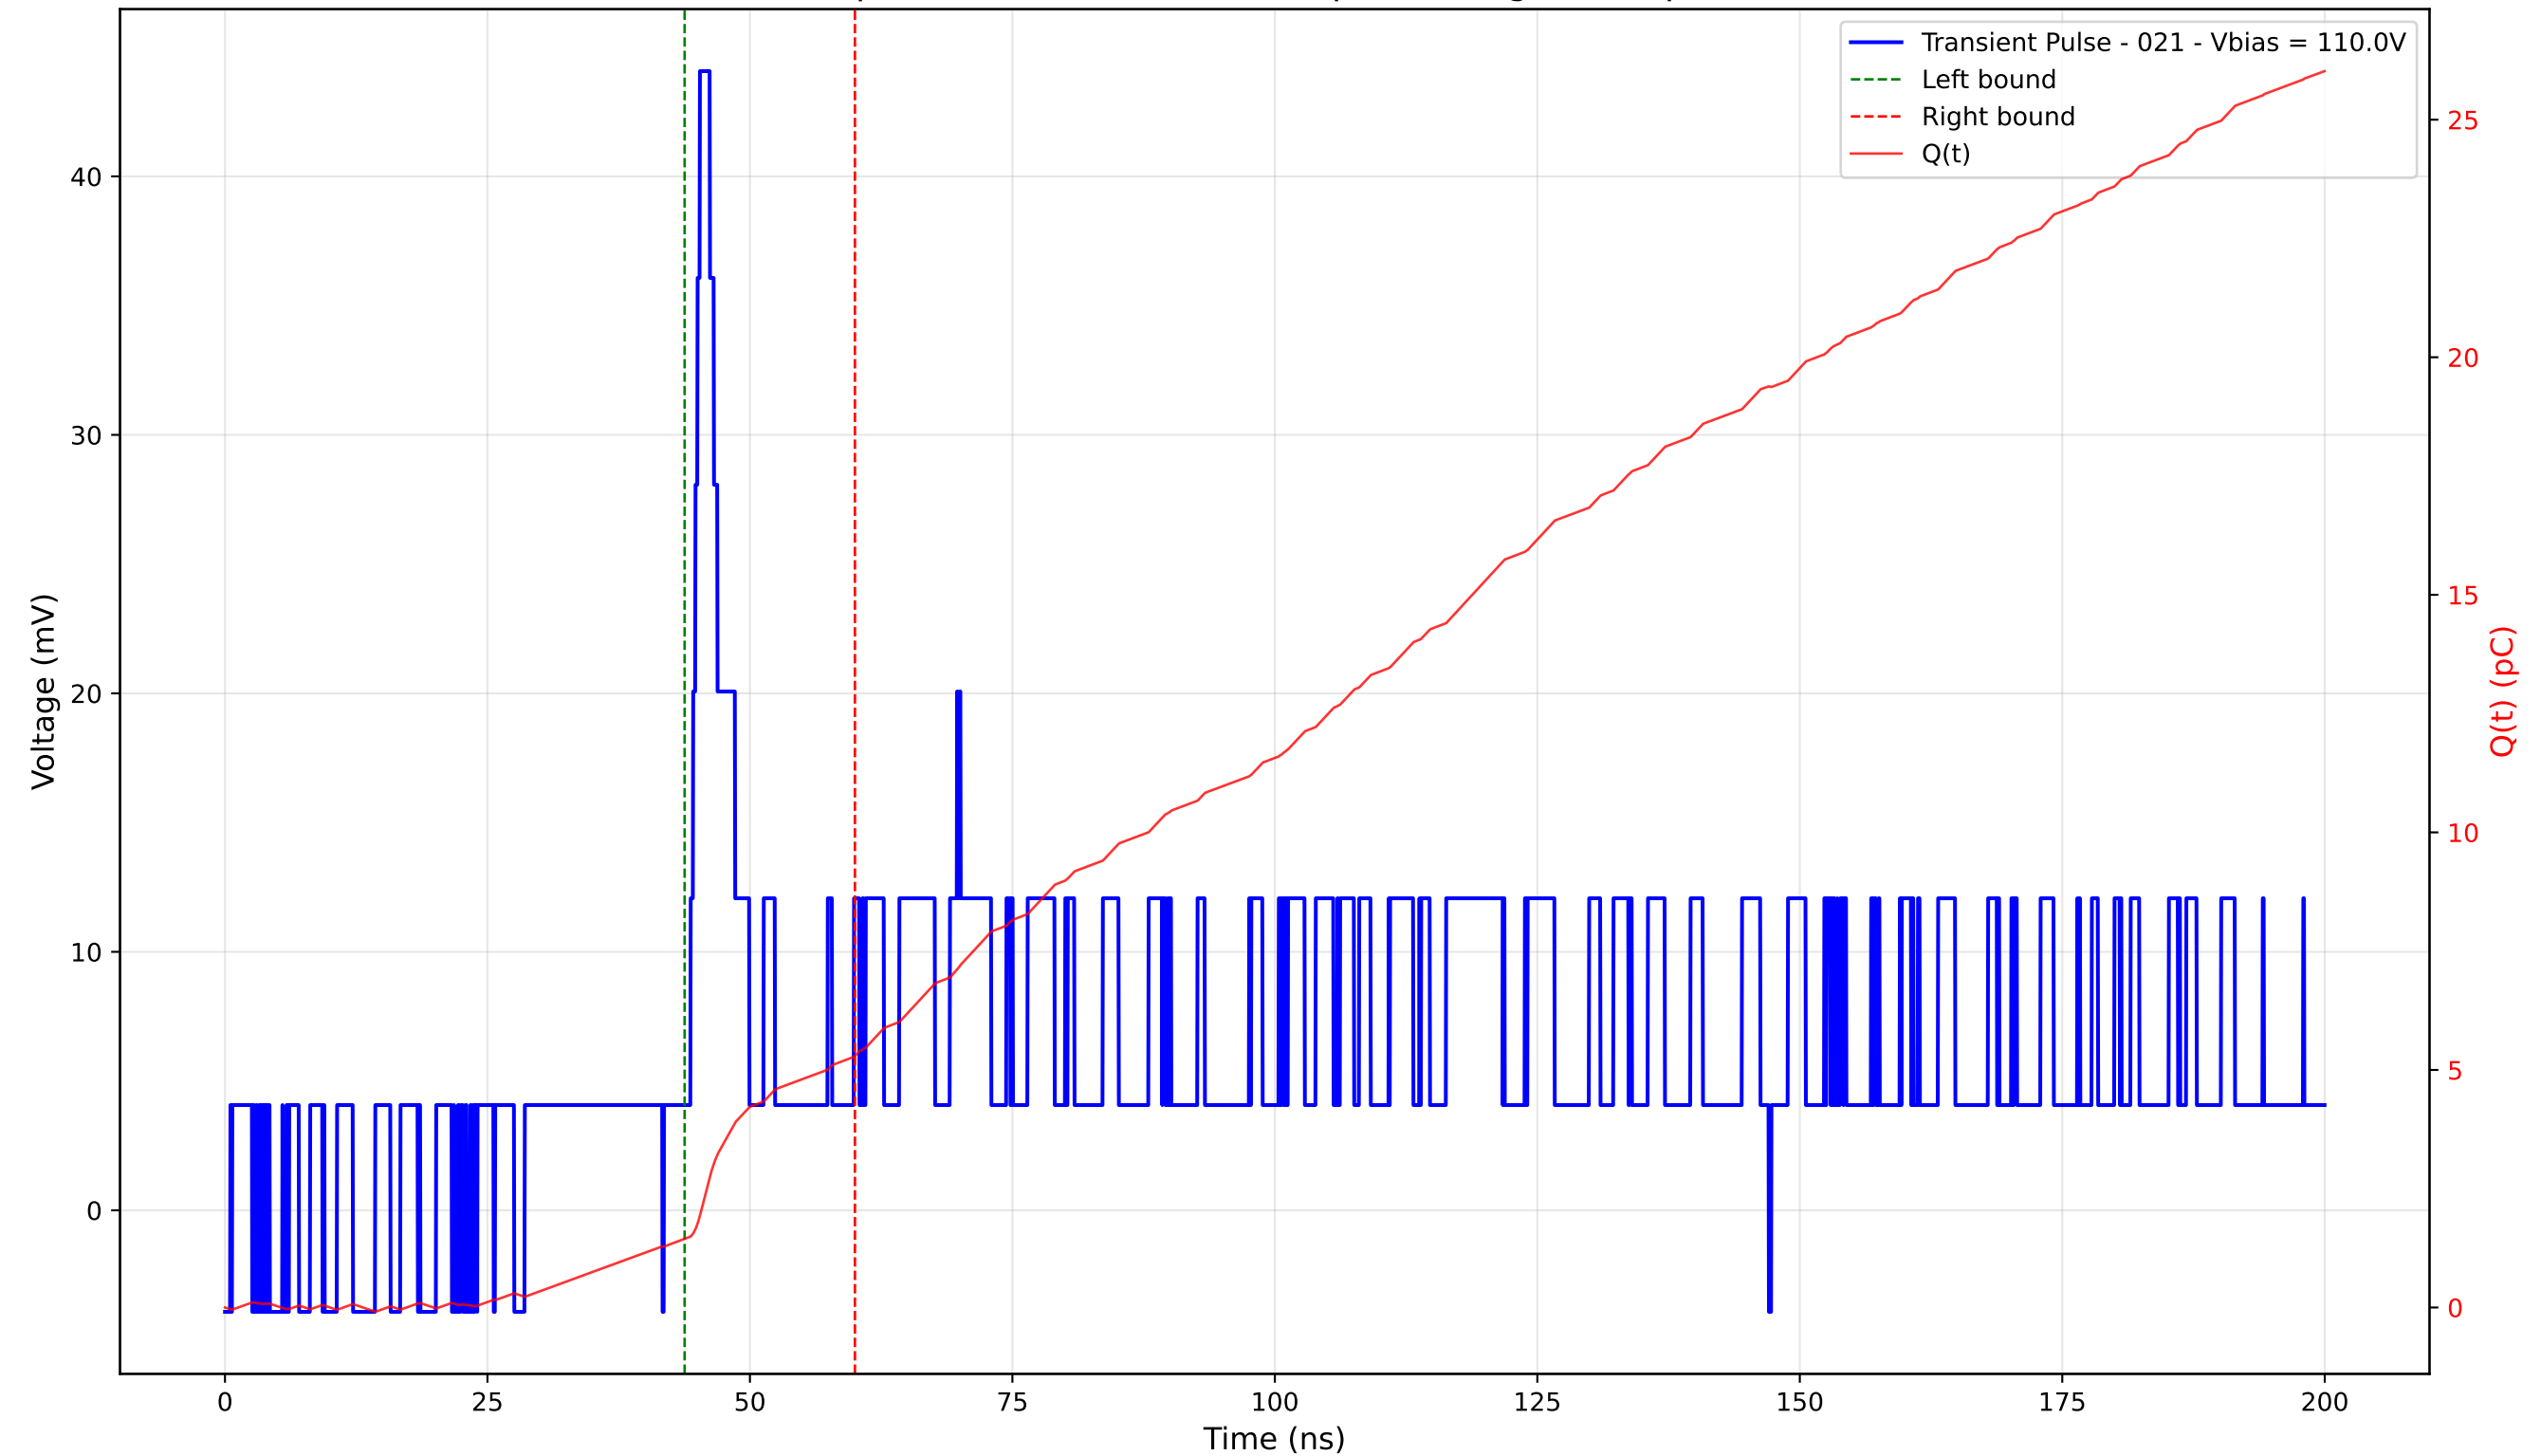


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 2.98 pC - Rise Time: 1.01 ns

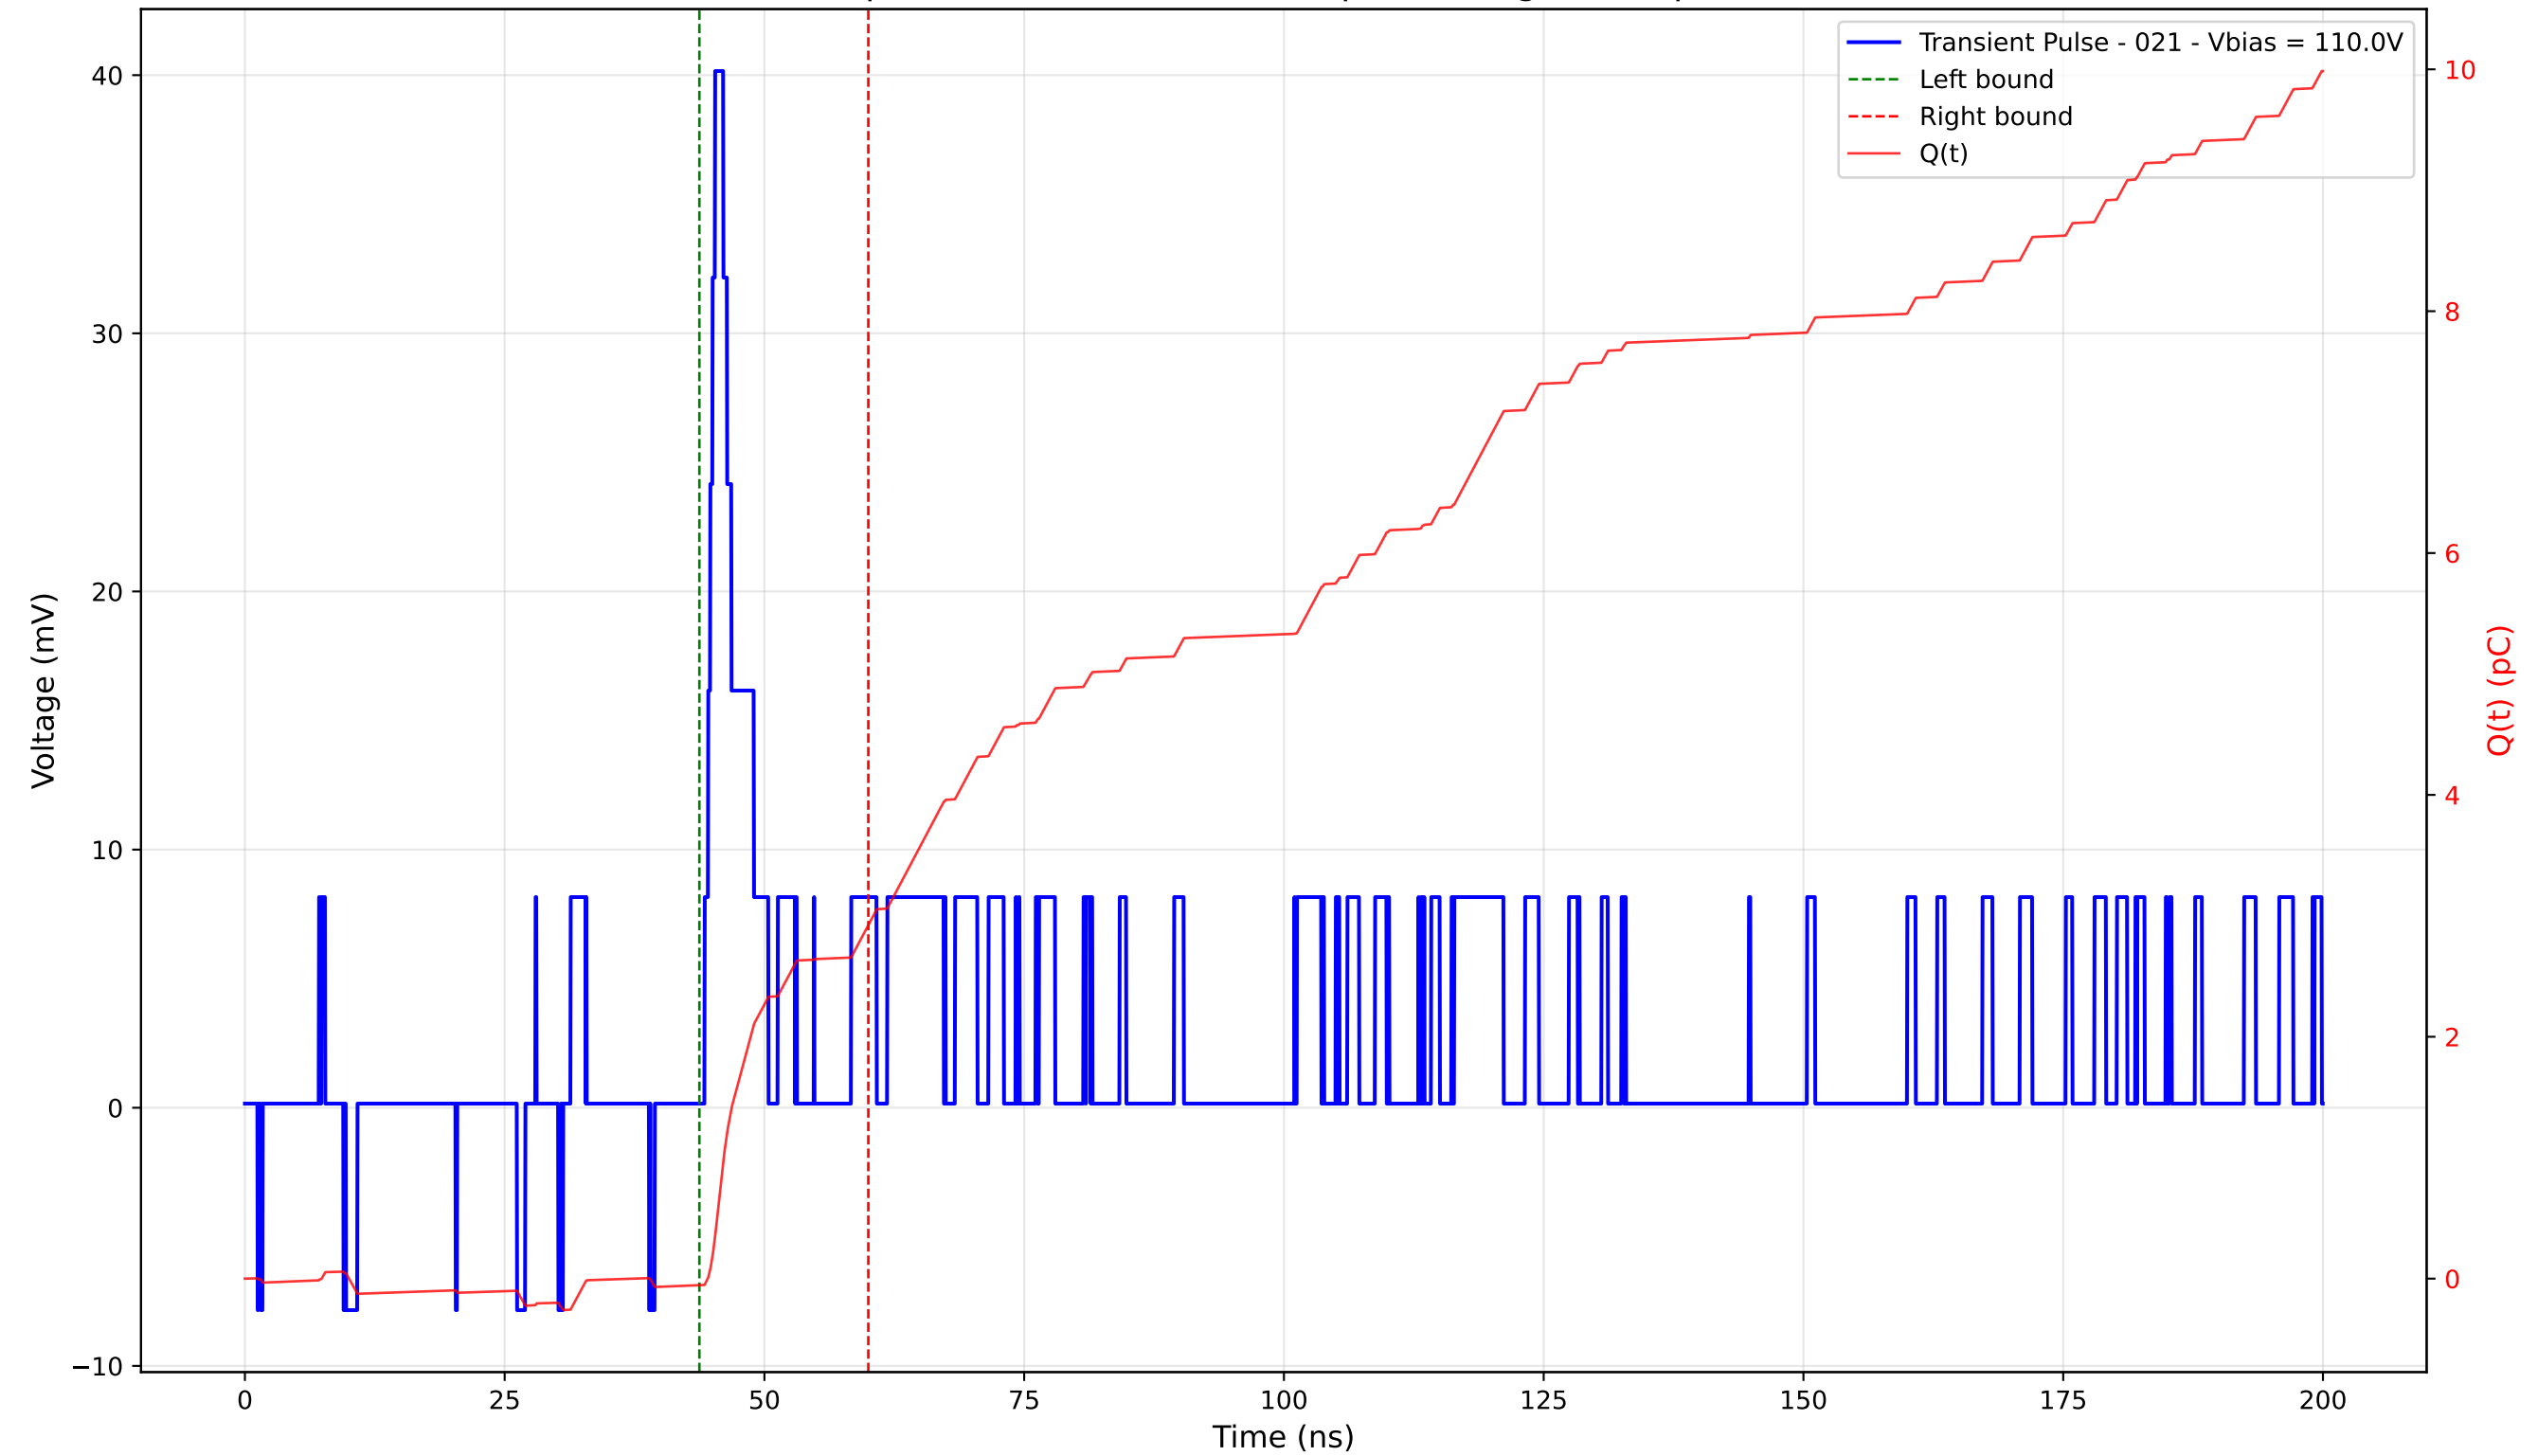


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 3.72 pC - Rise Time: 8.54 ns

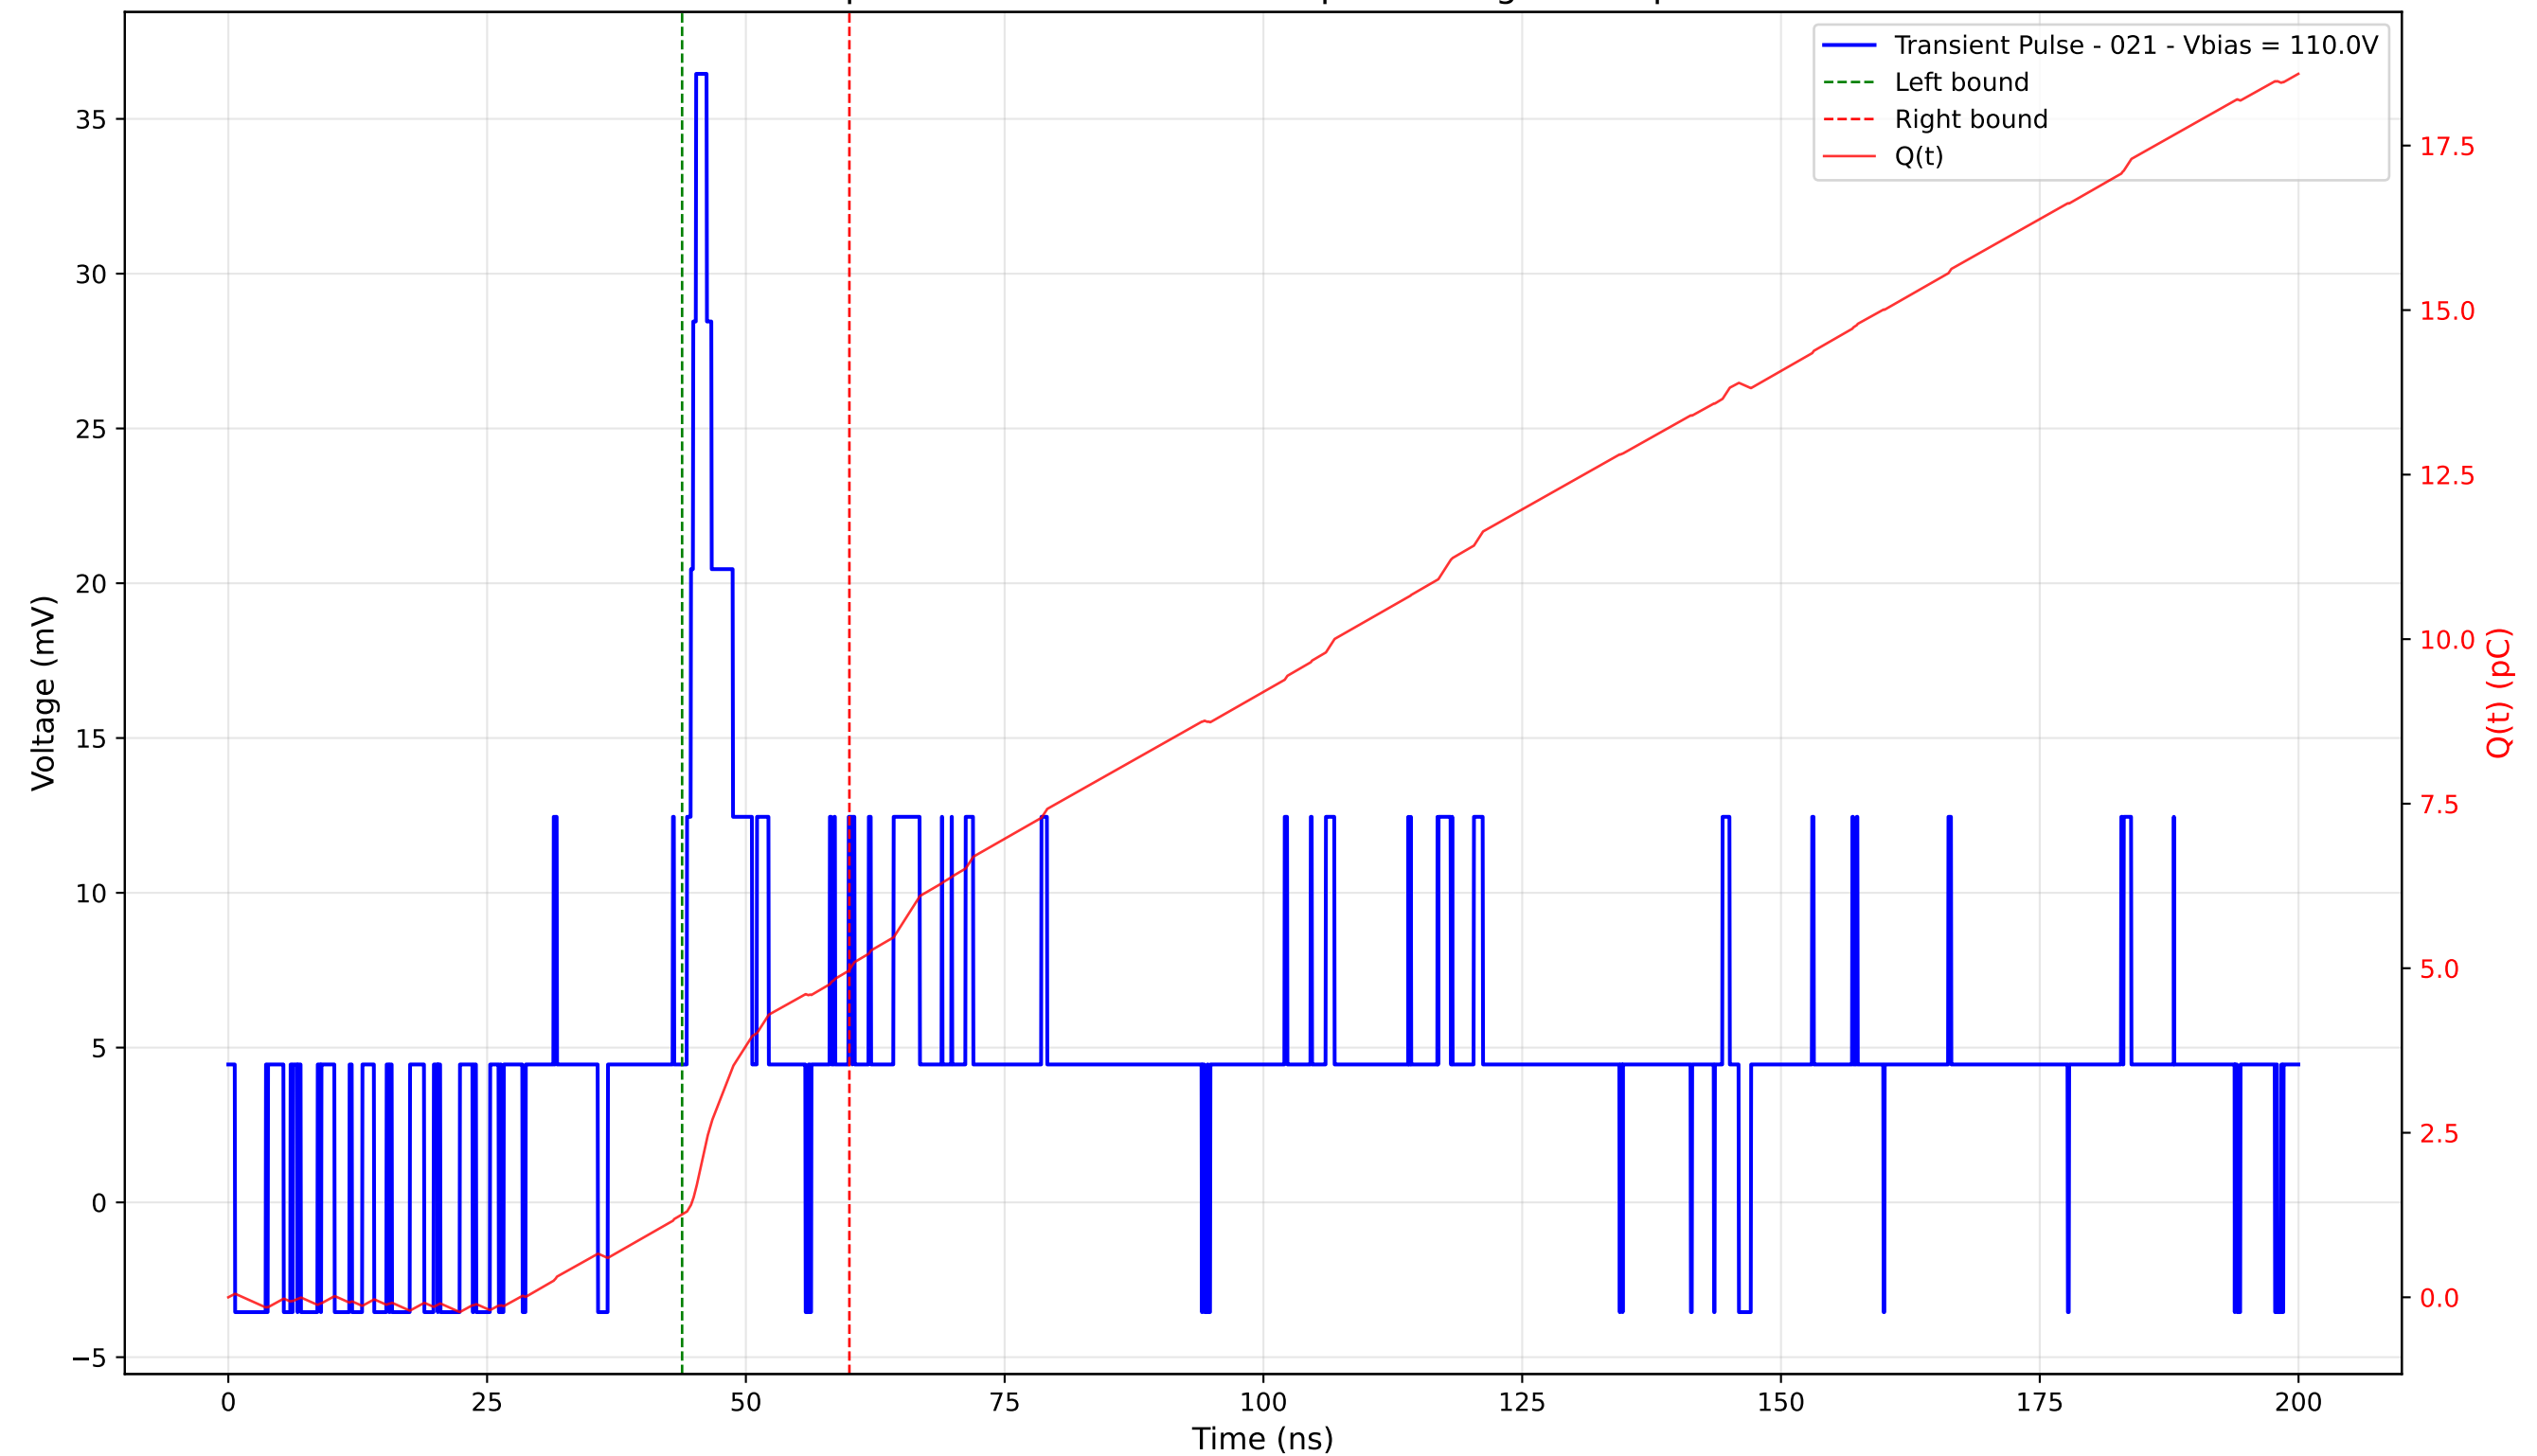


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 2.87 pC - Rise Time: 0.89 ns

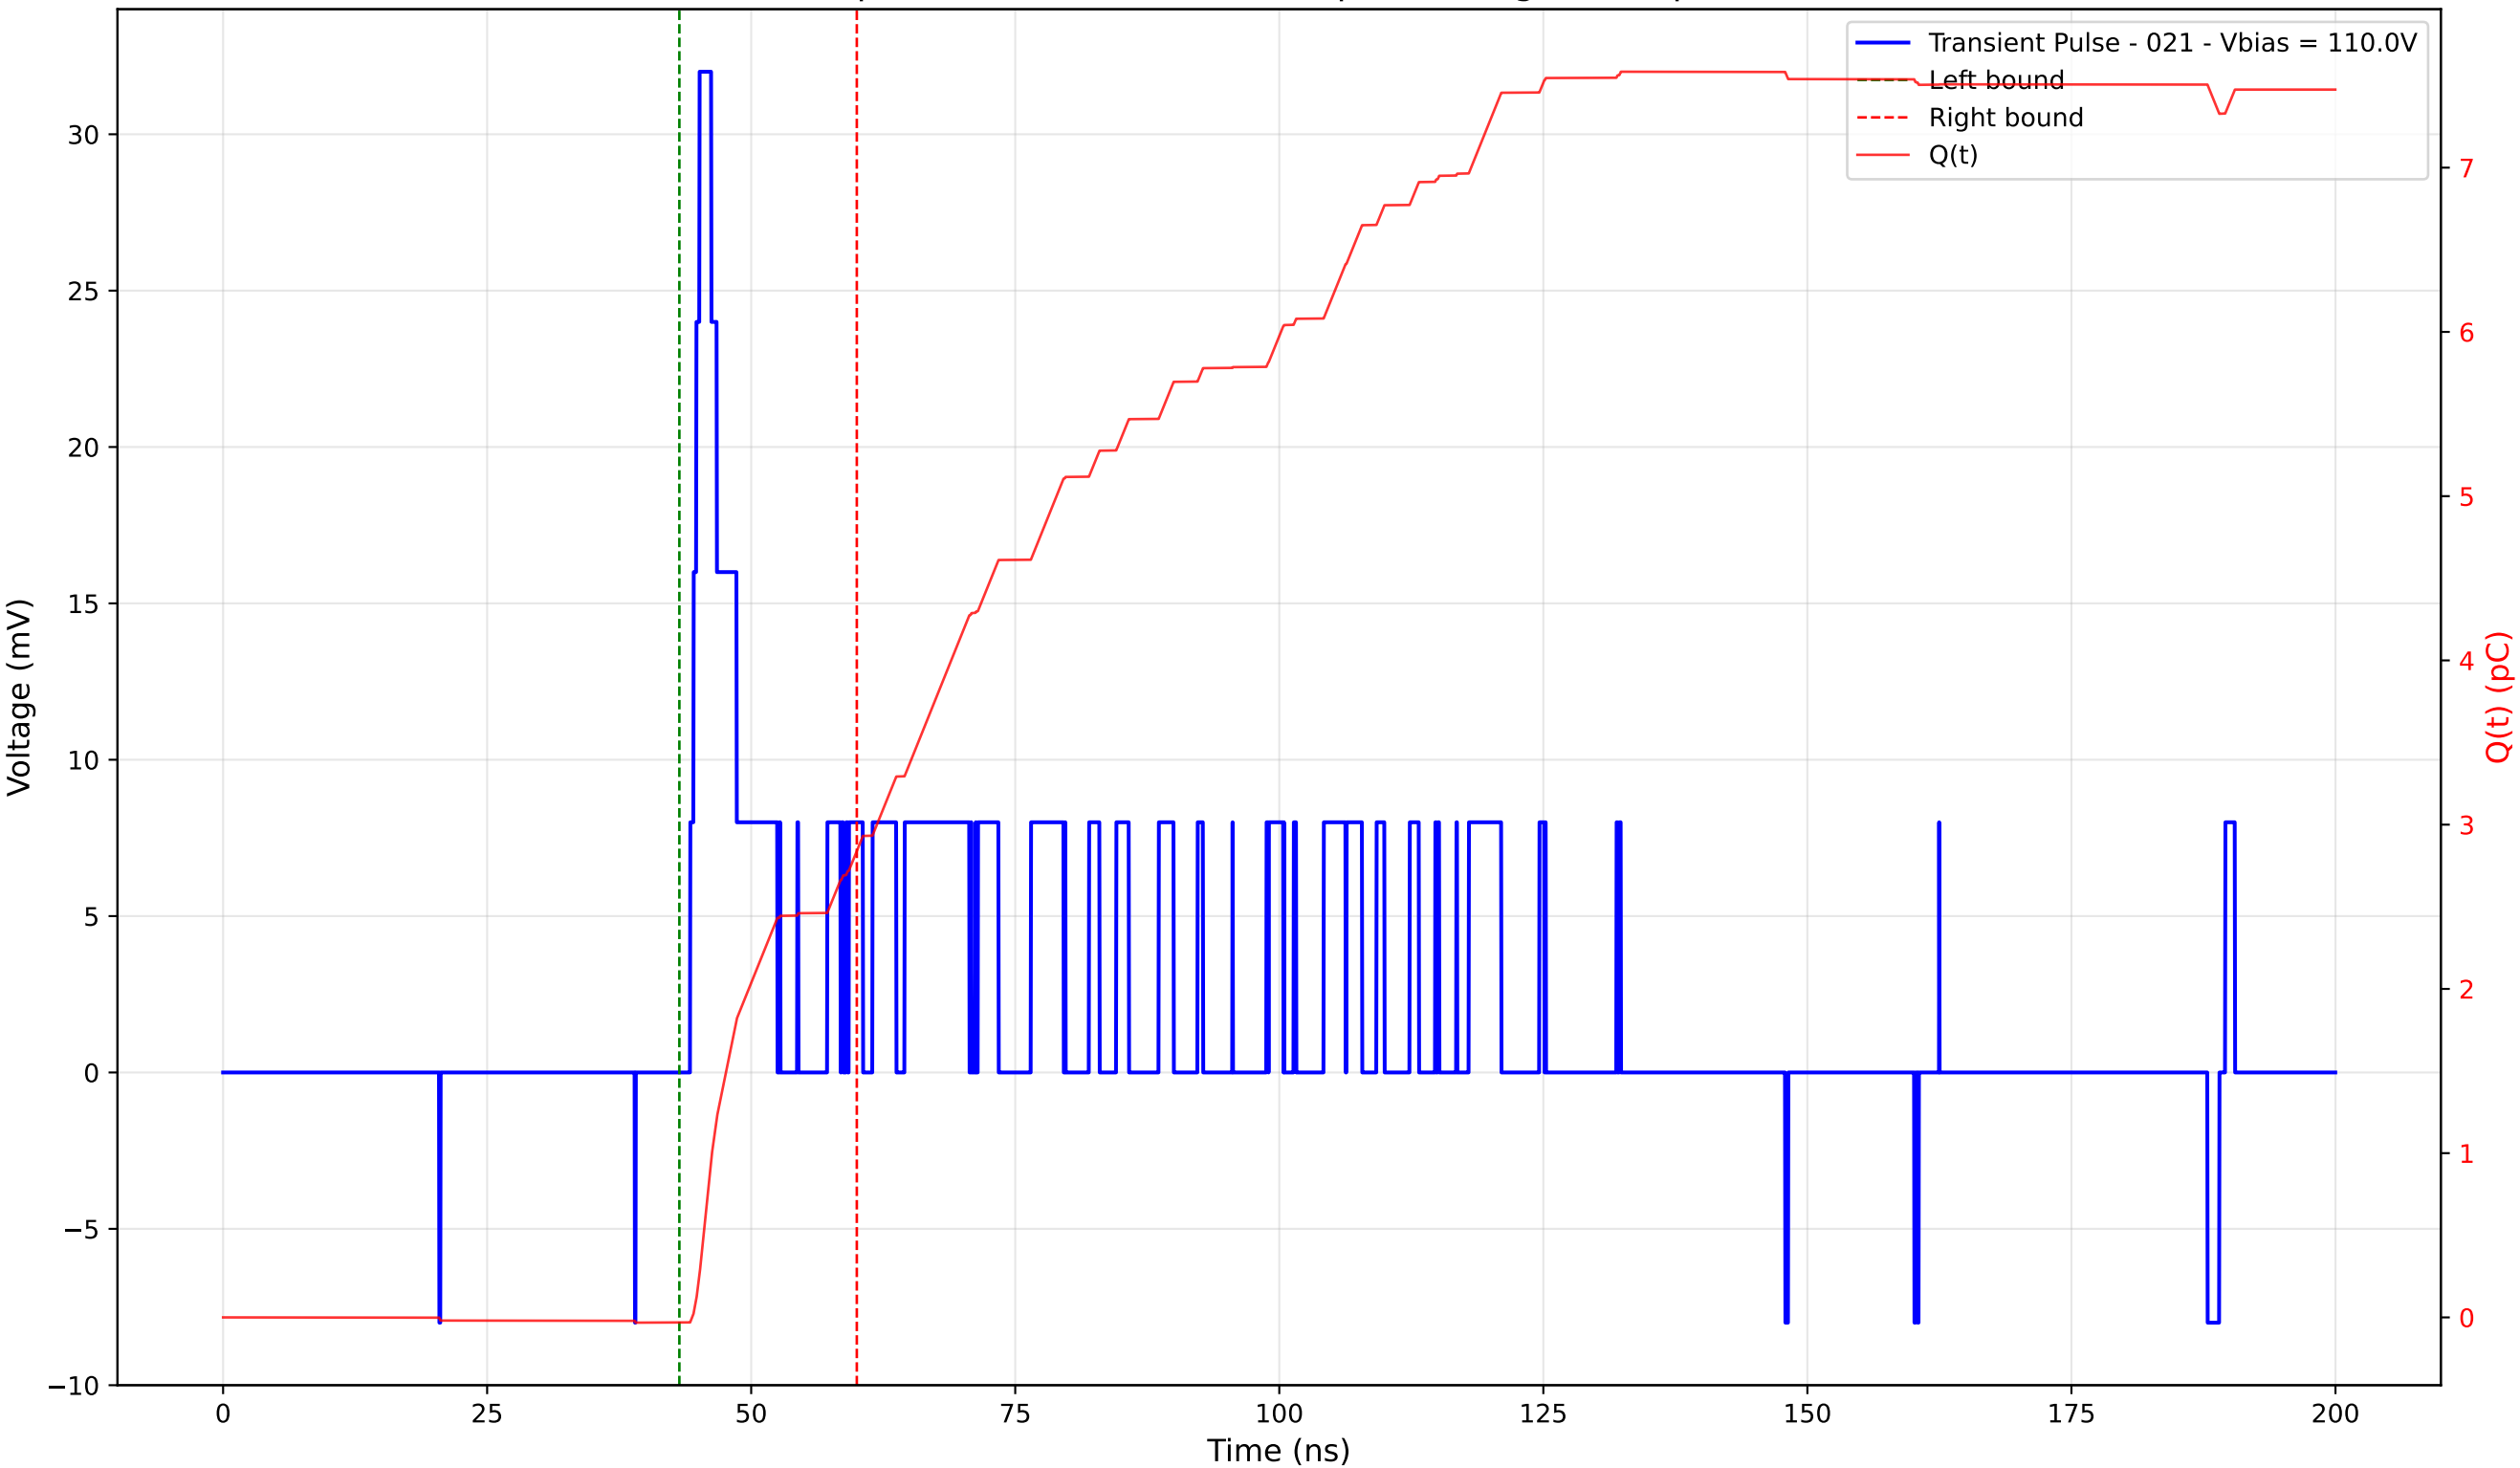


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 2.92 pC - Rise Time: 1.21 ns

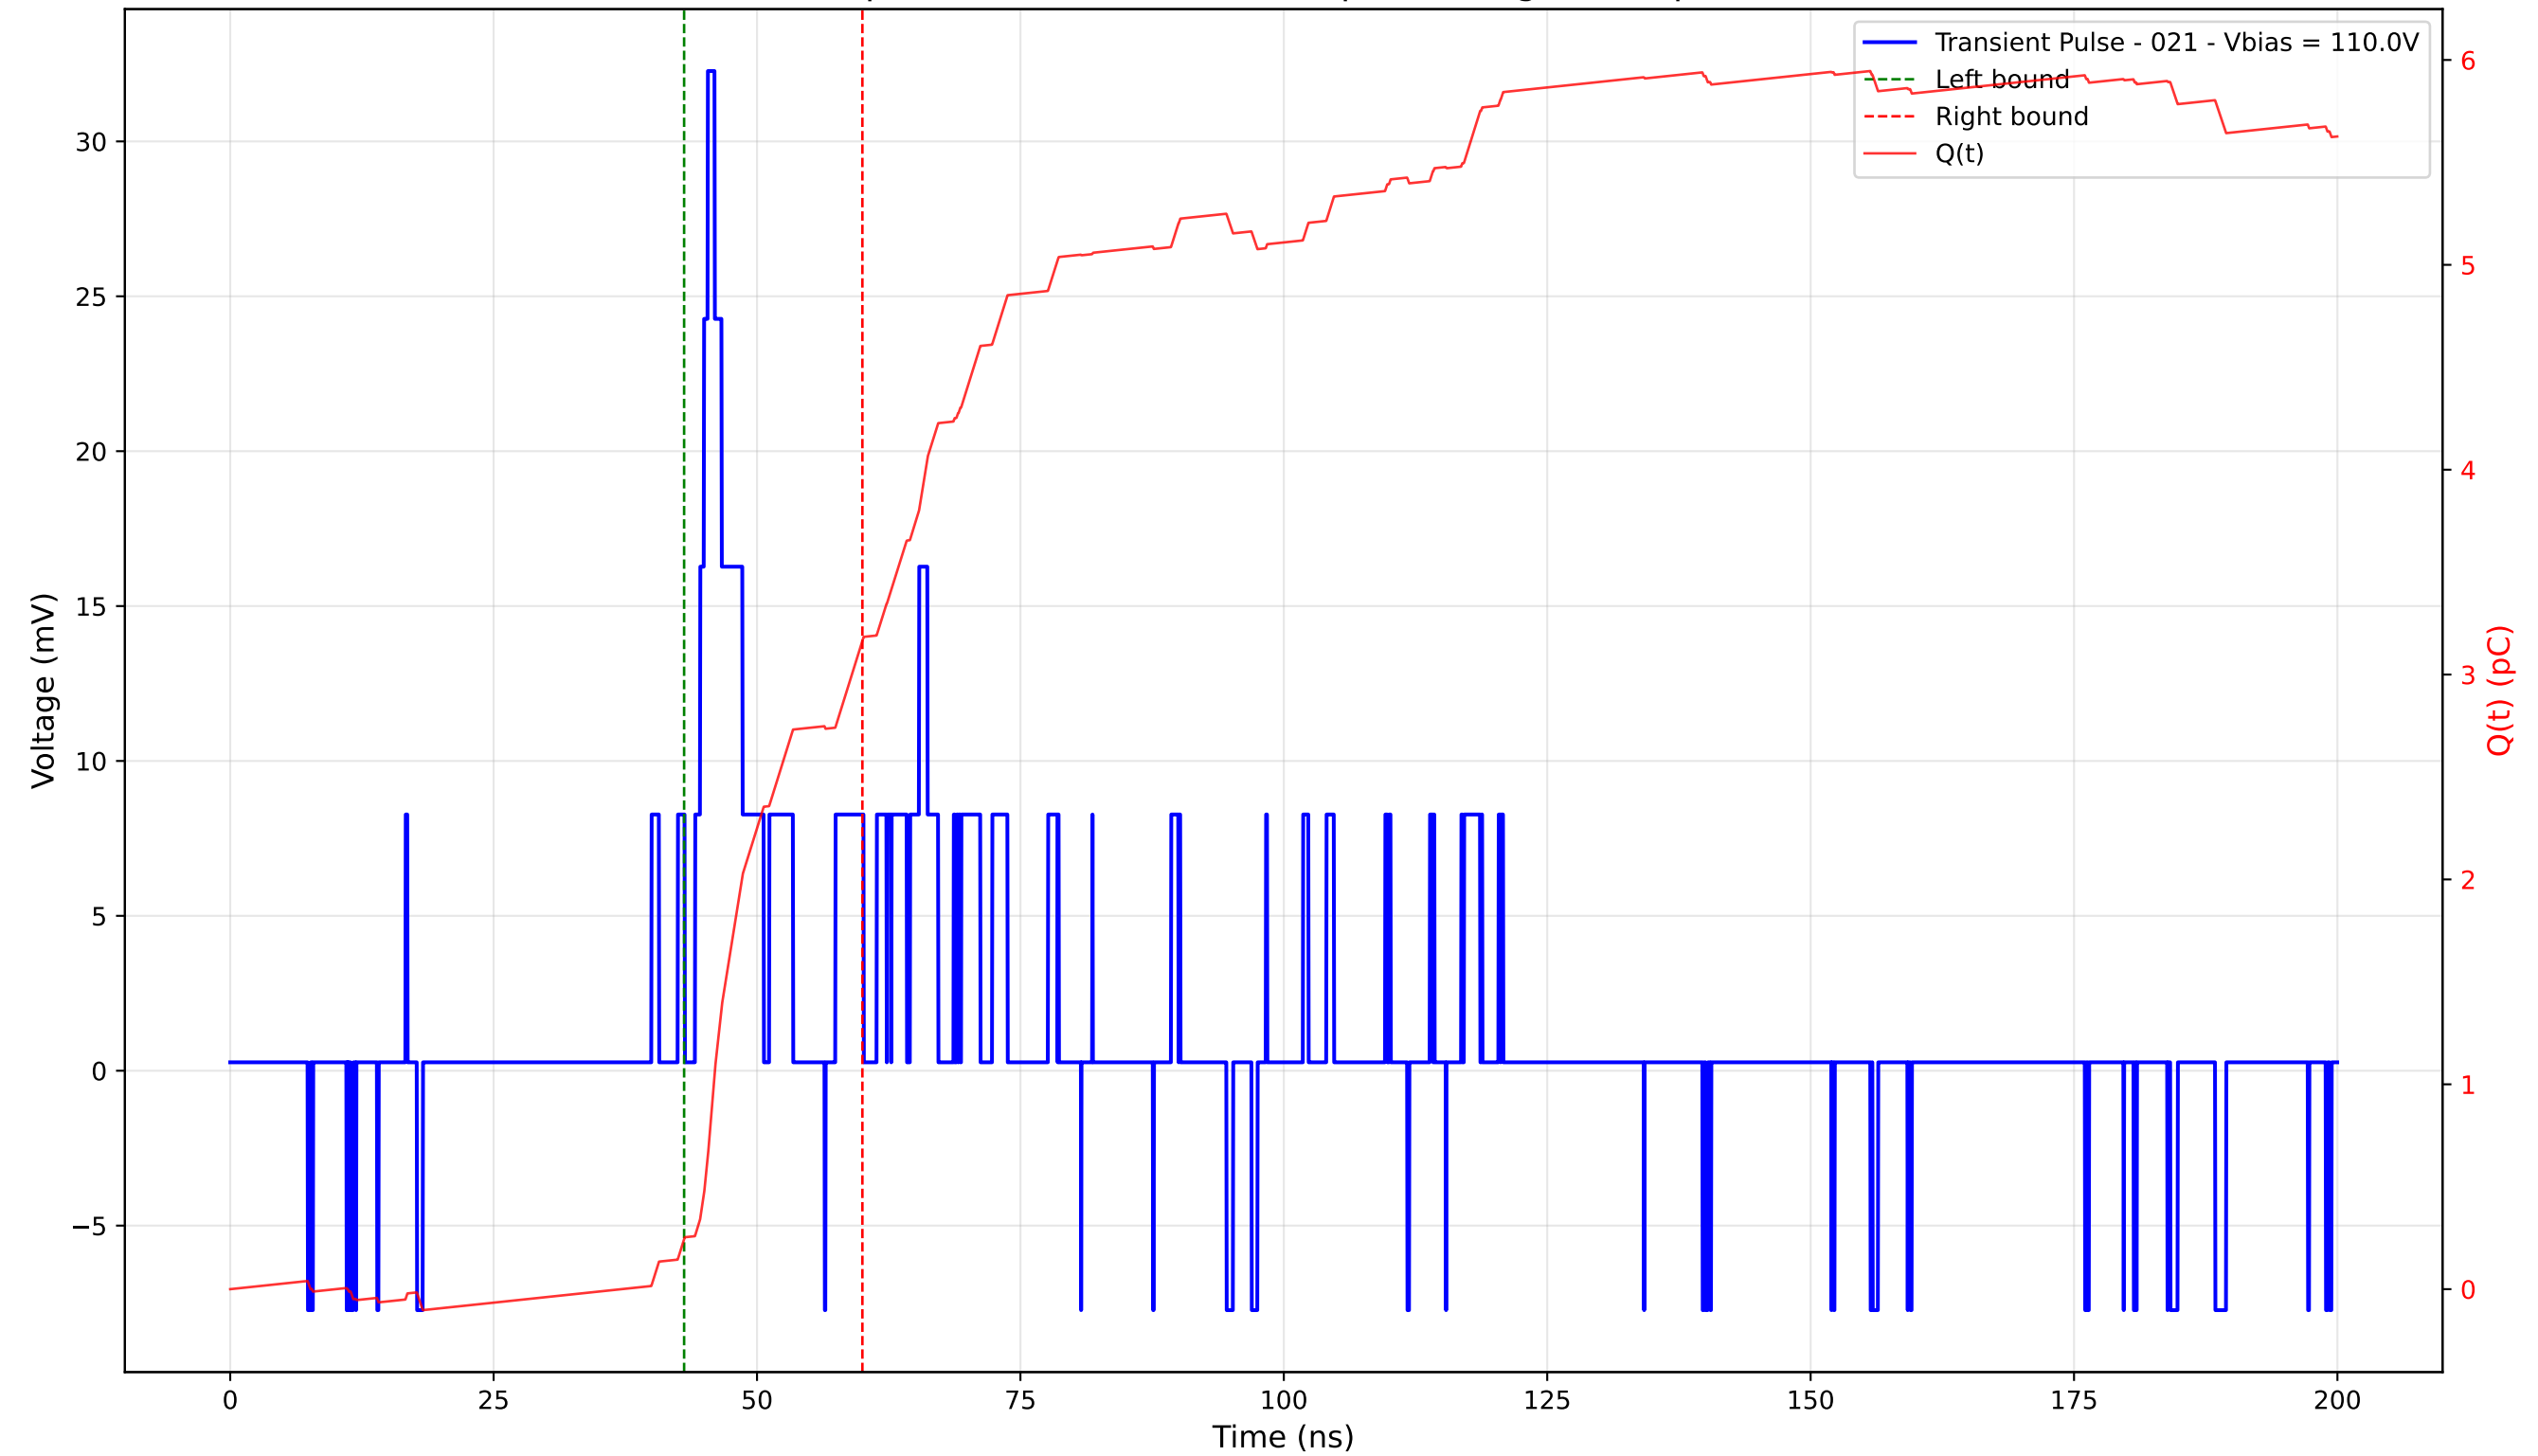


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 3.14 pC - Rise Time: 2.72 ns

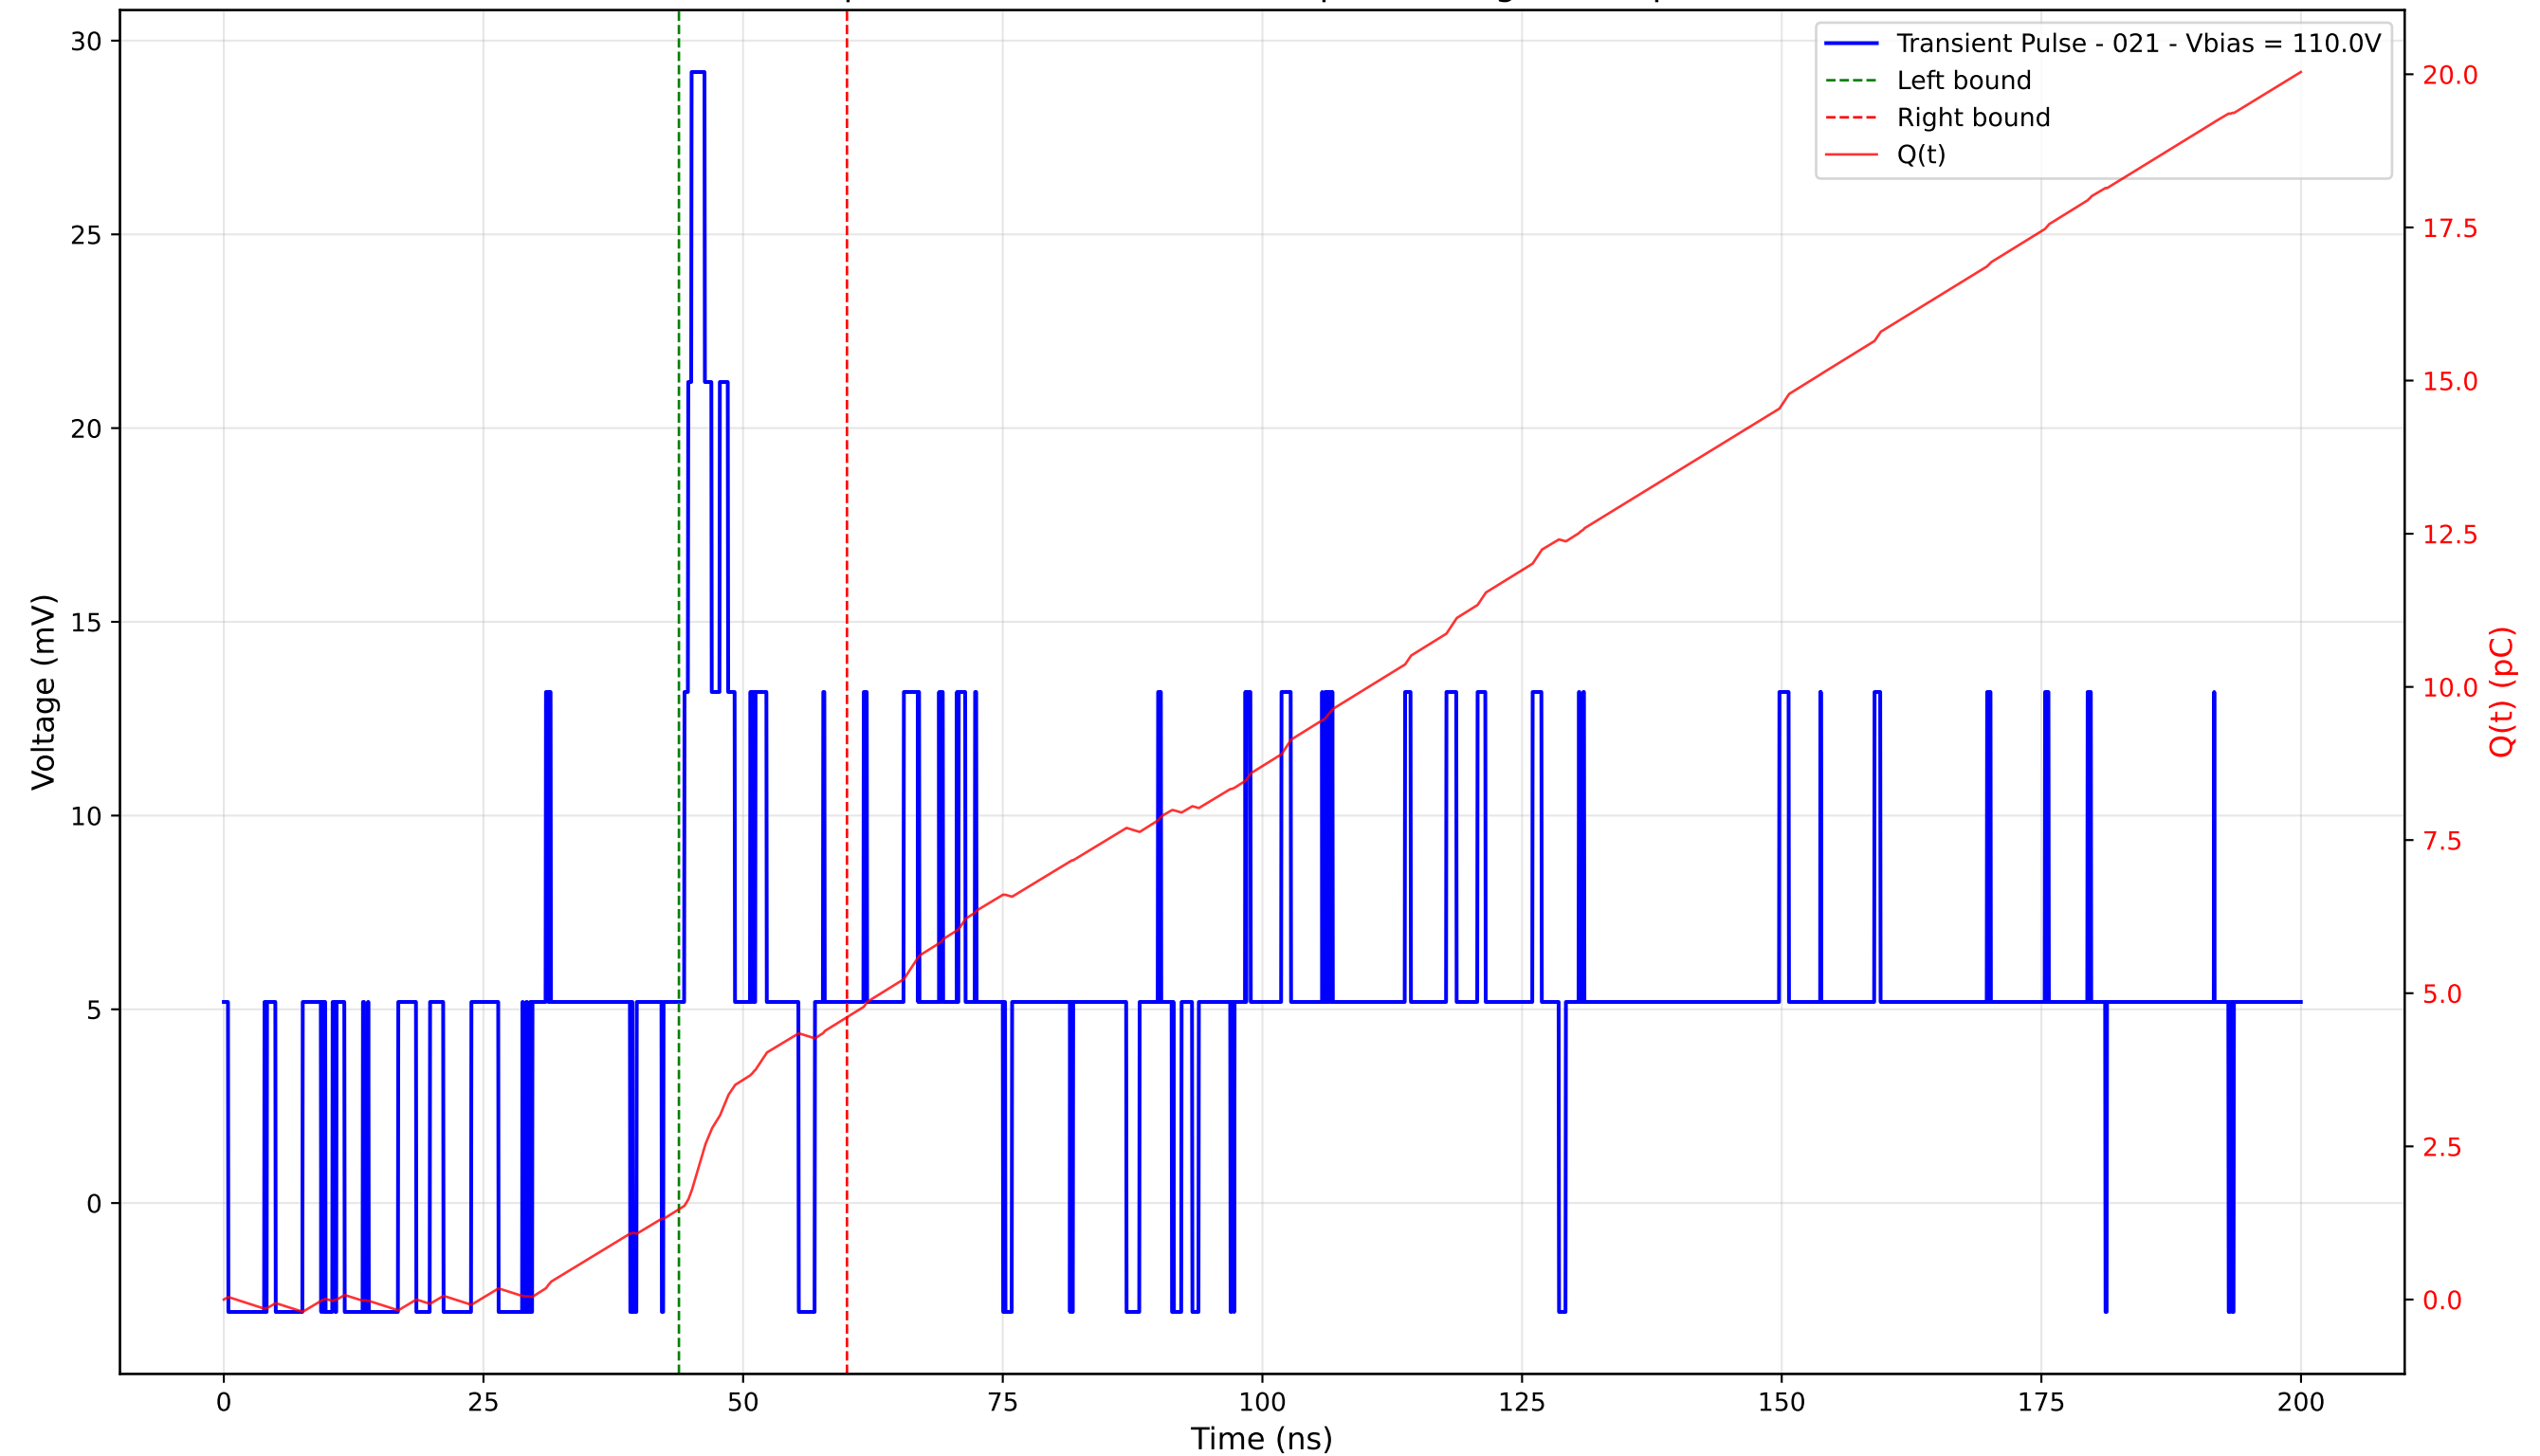


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 2.37 pC - Rise Time: 0.97 ns

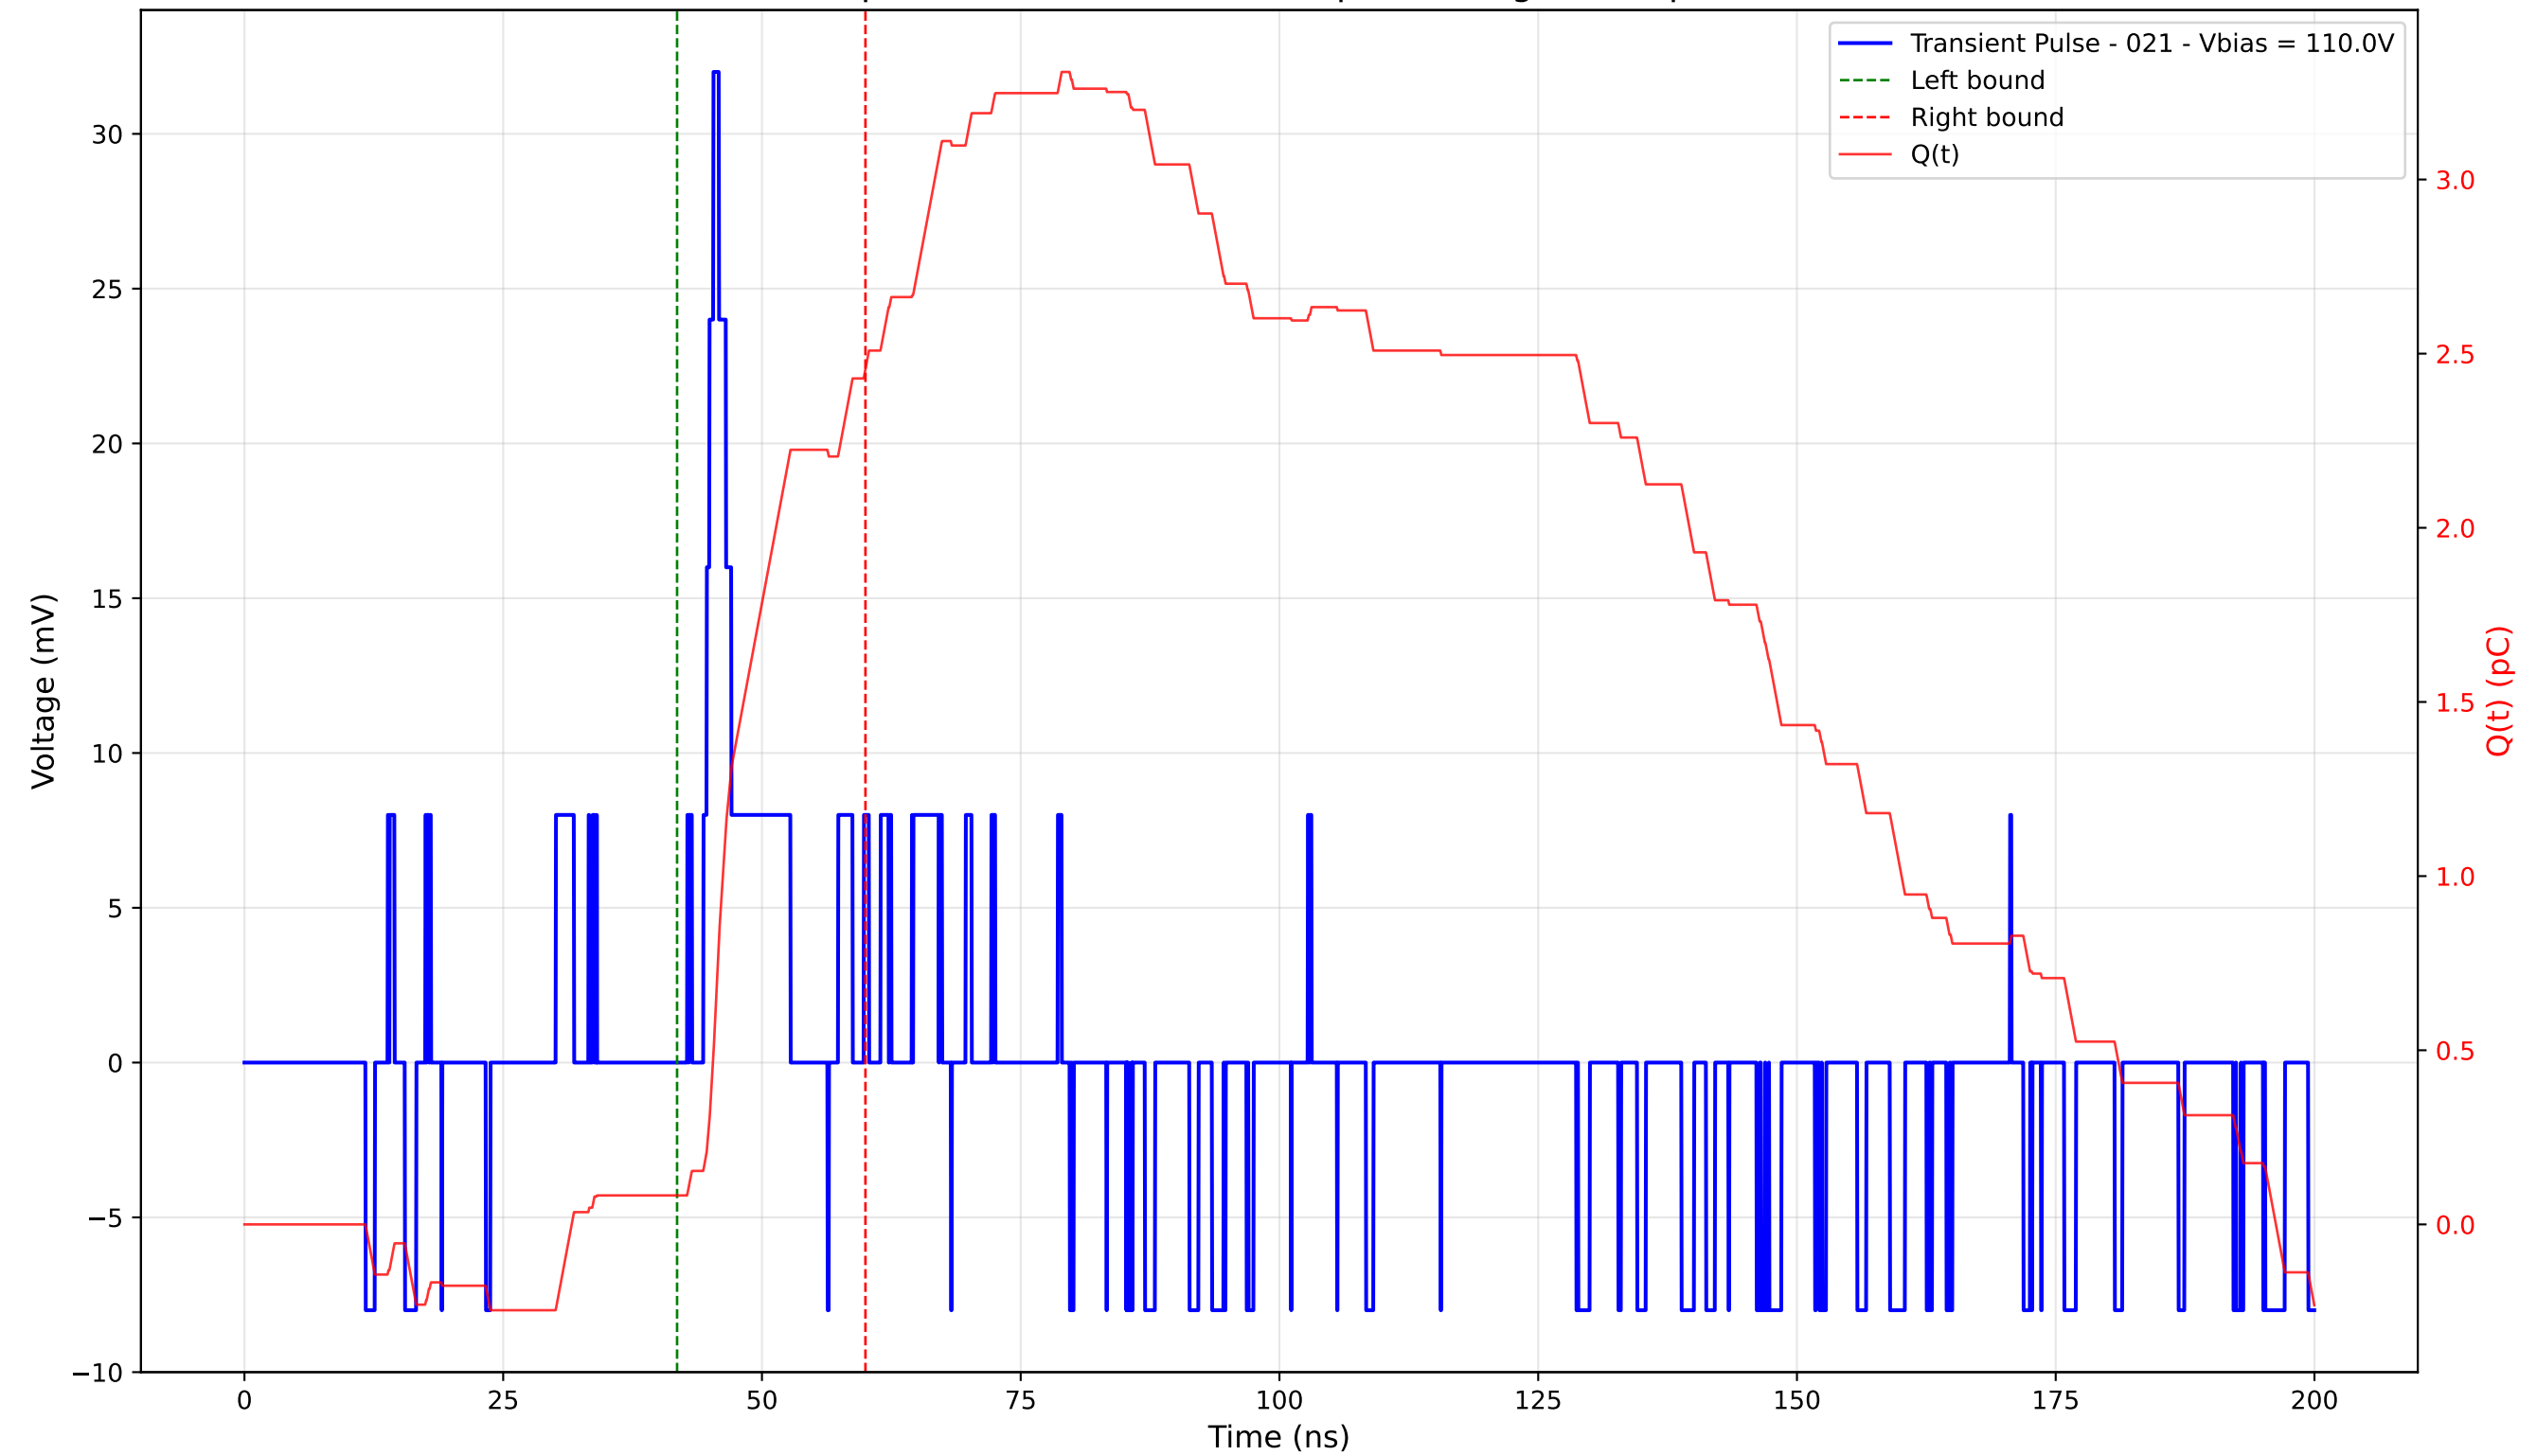


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 3.01 pC - Rise Time: 0.00 ns (N/A)

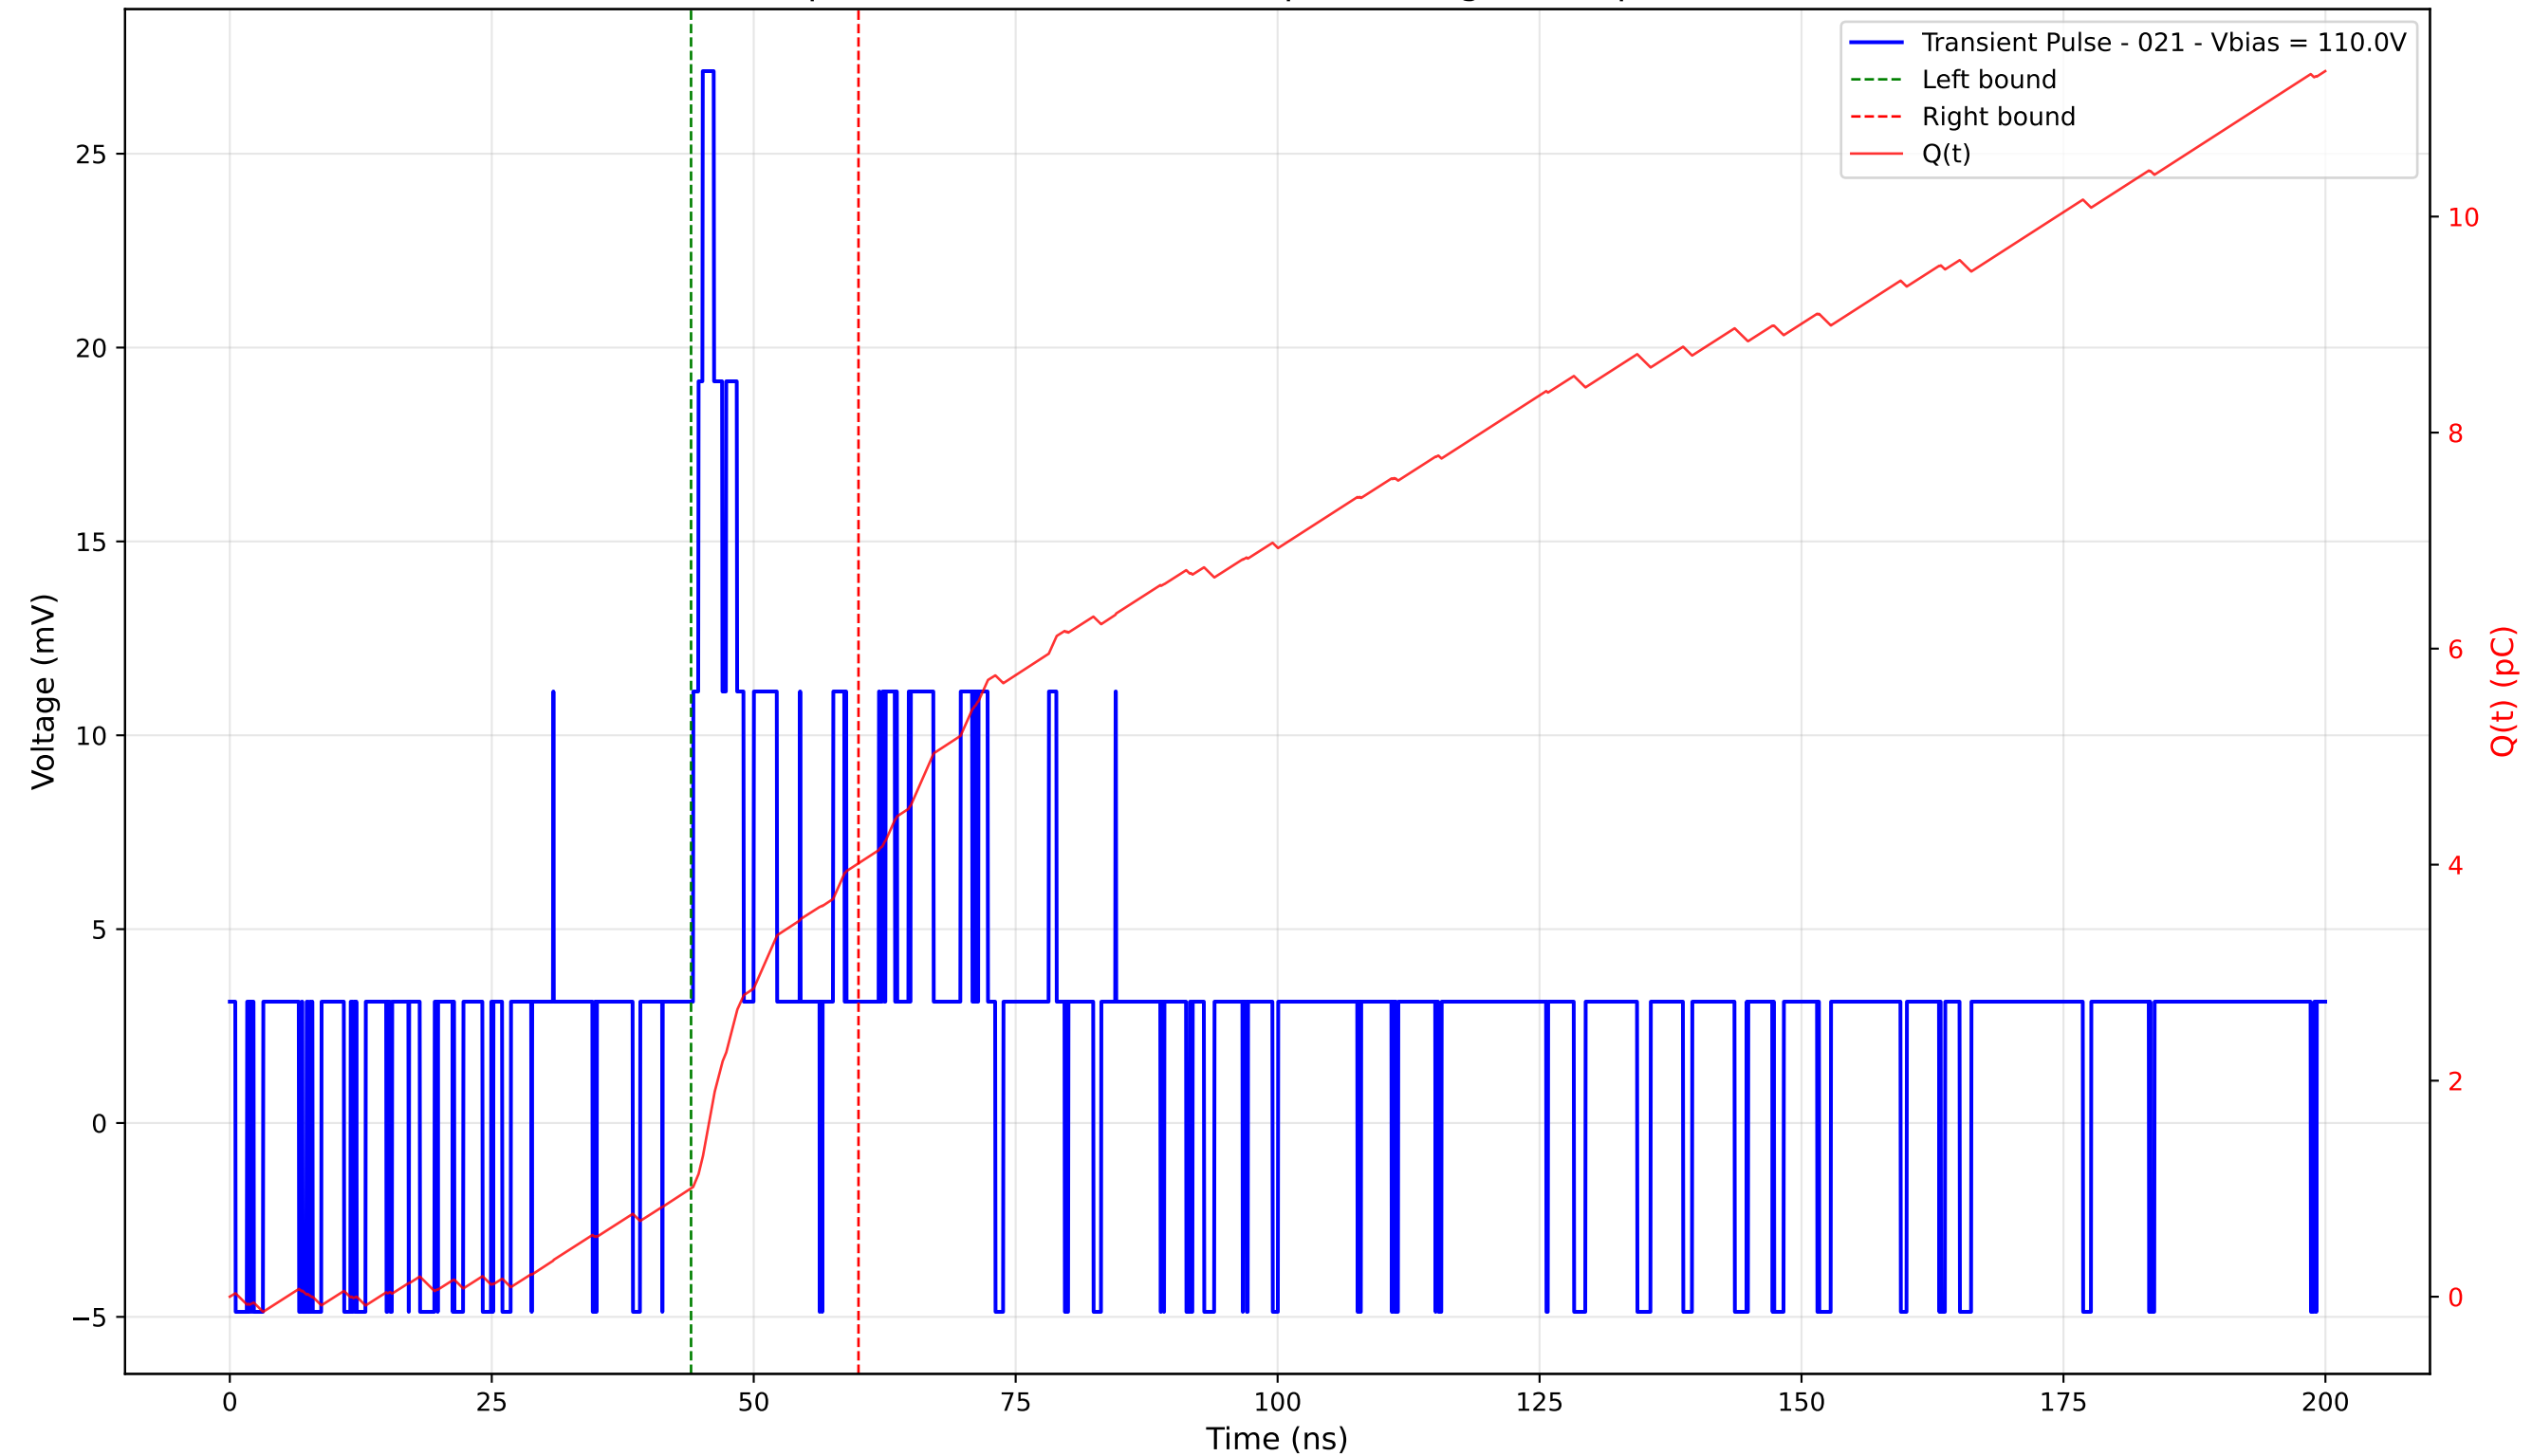


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 2.81 pC - Rise Time: 1.41 ns

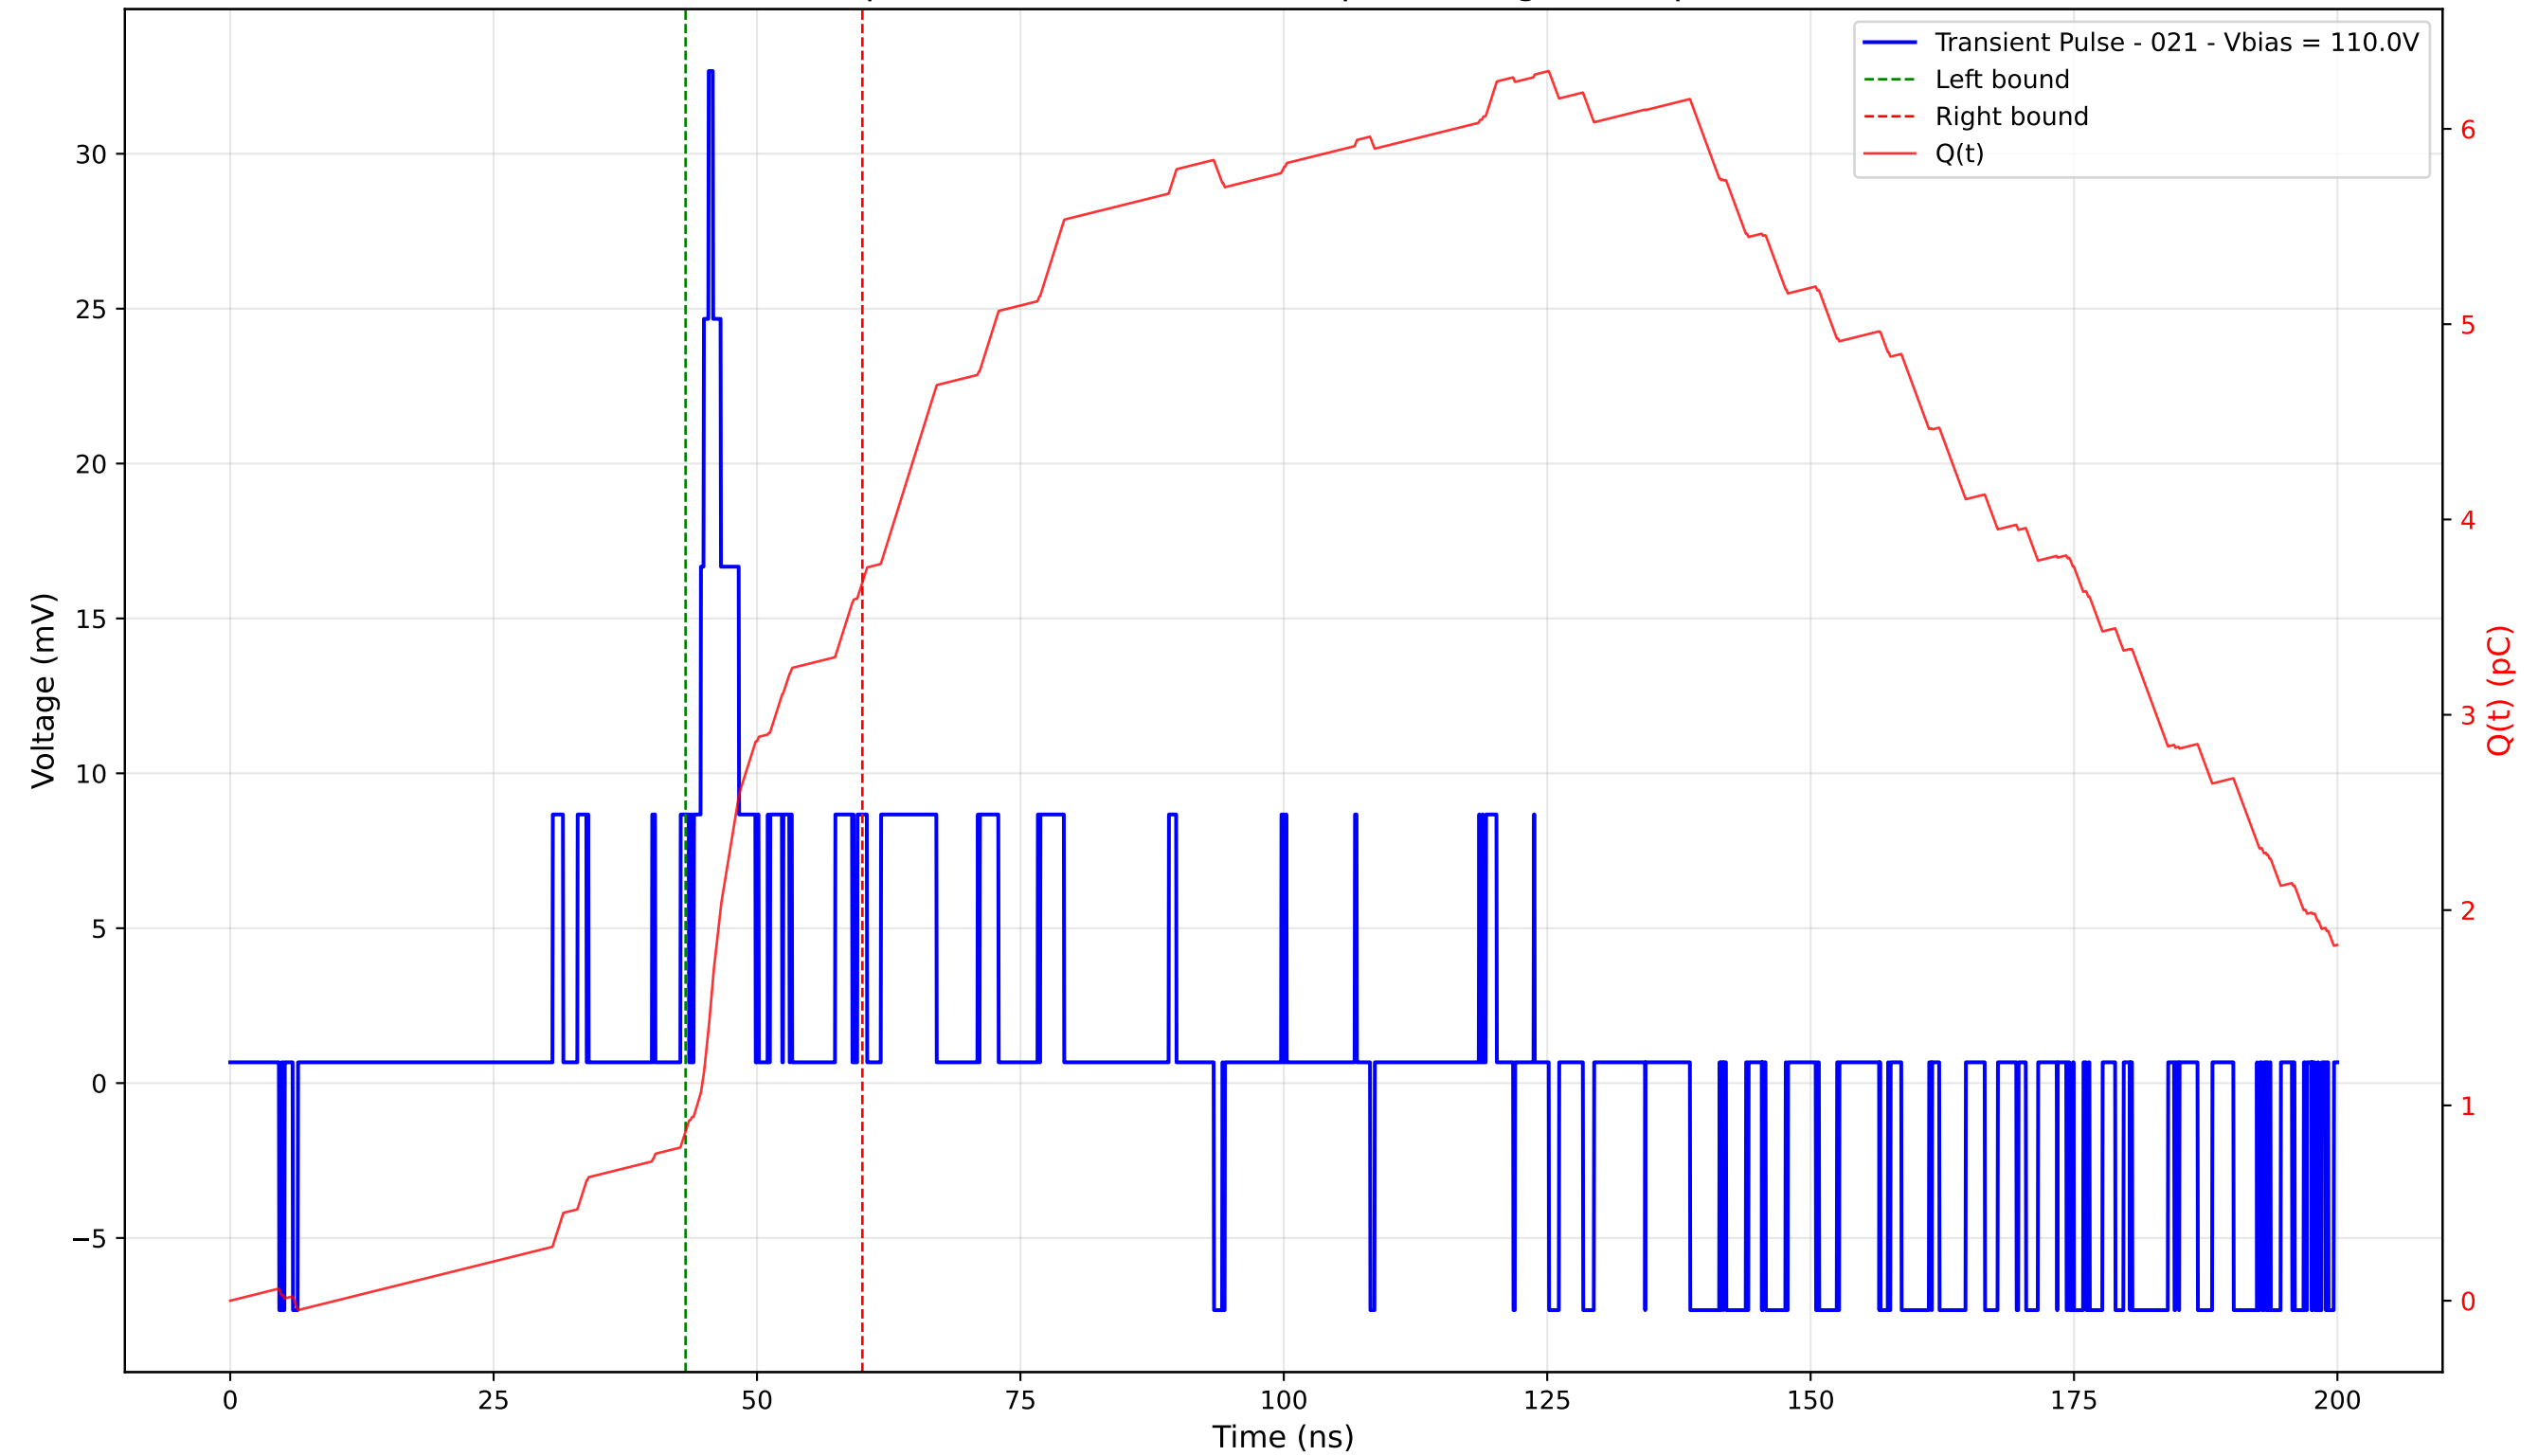


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 2.59 pC - Rise Time: 1.20 ns

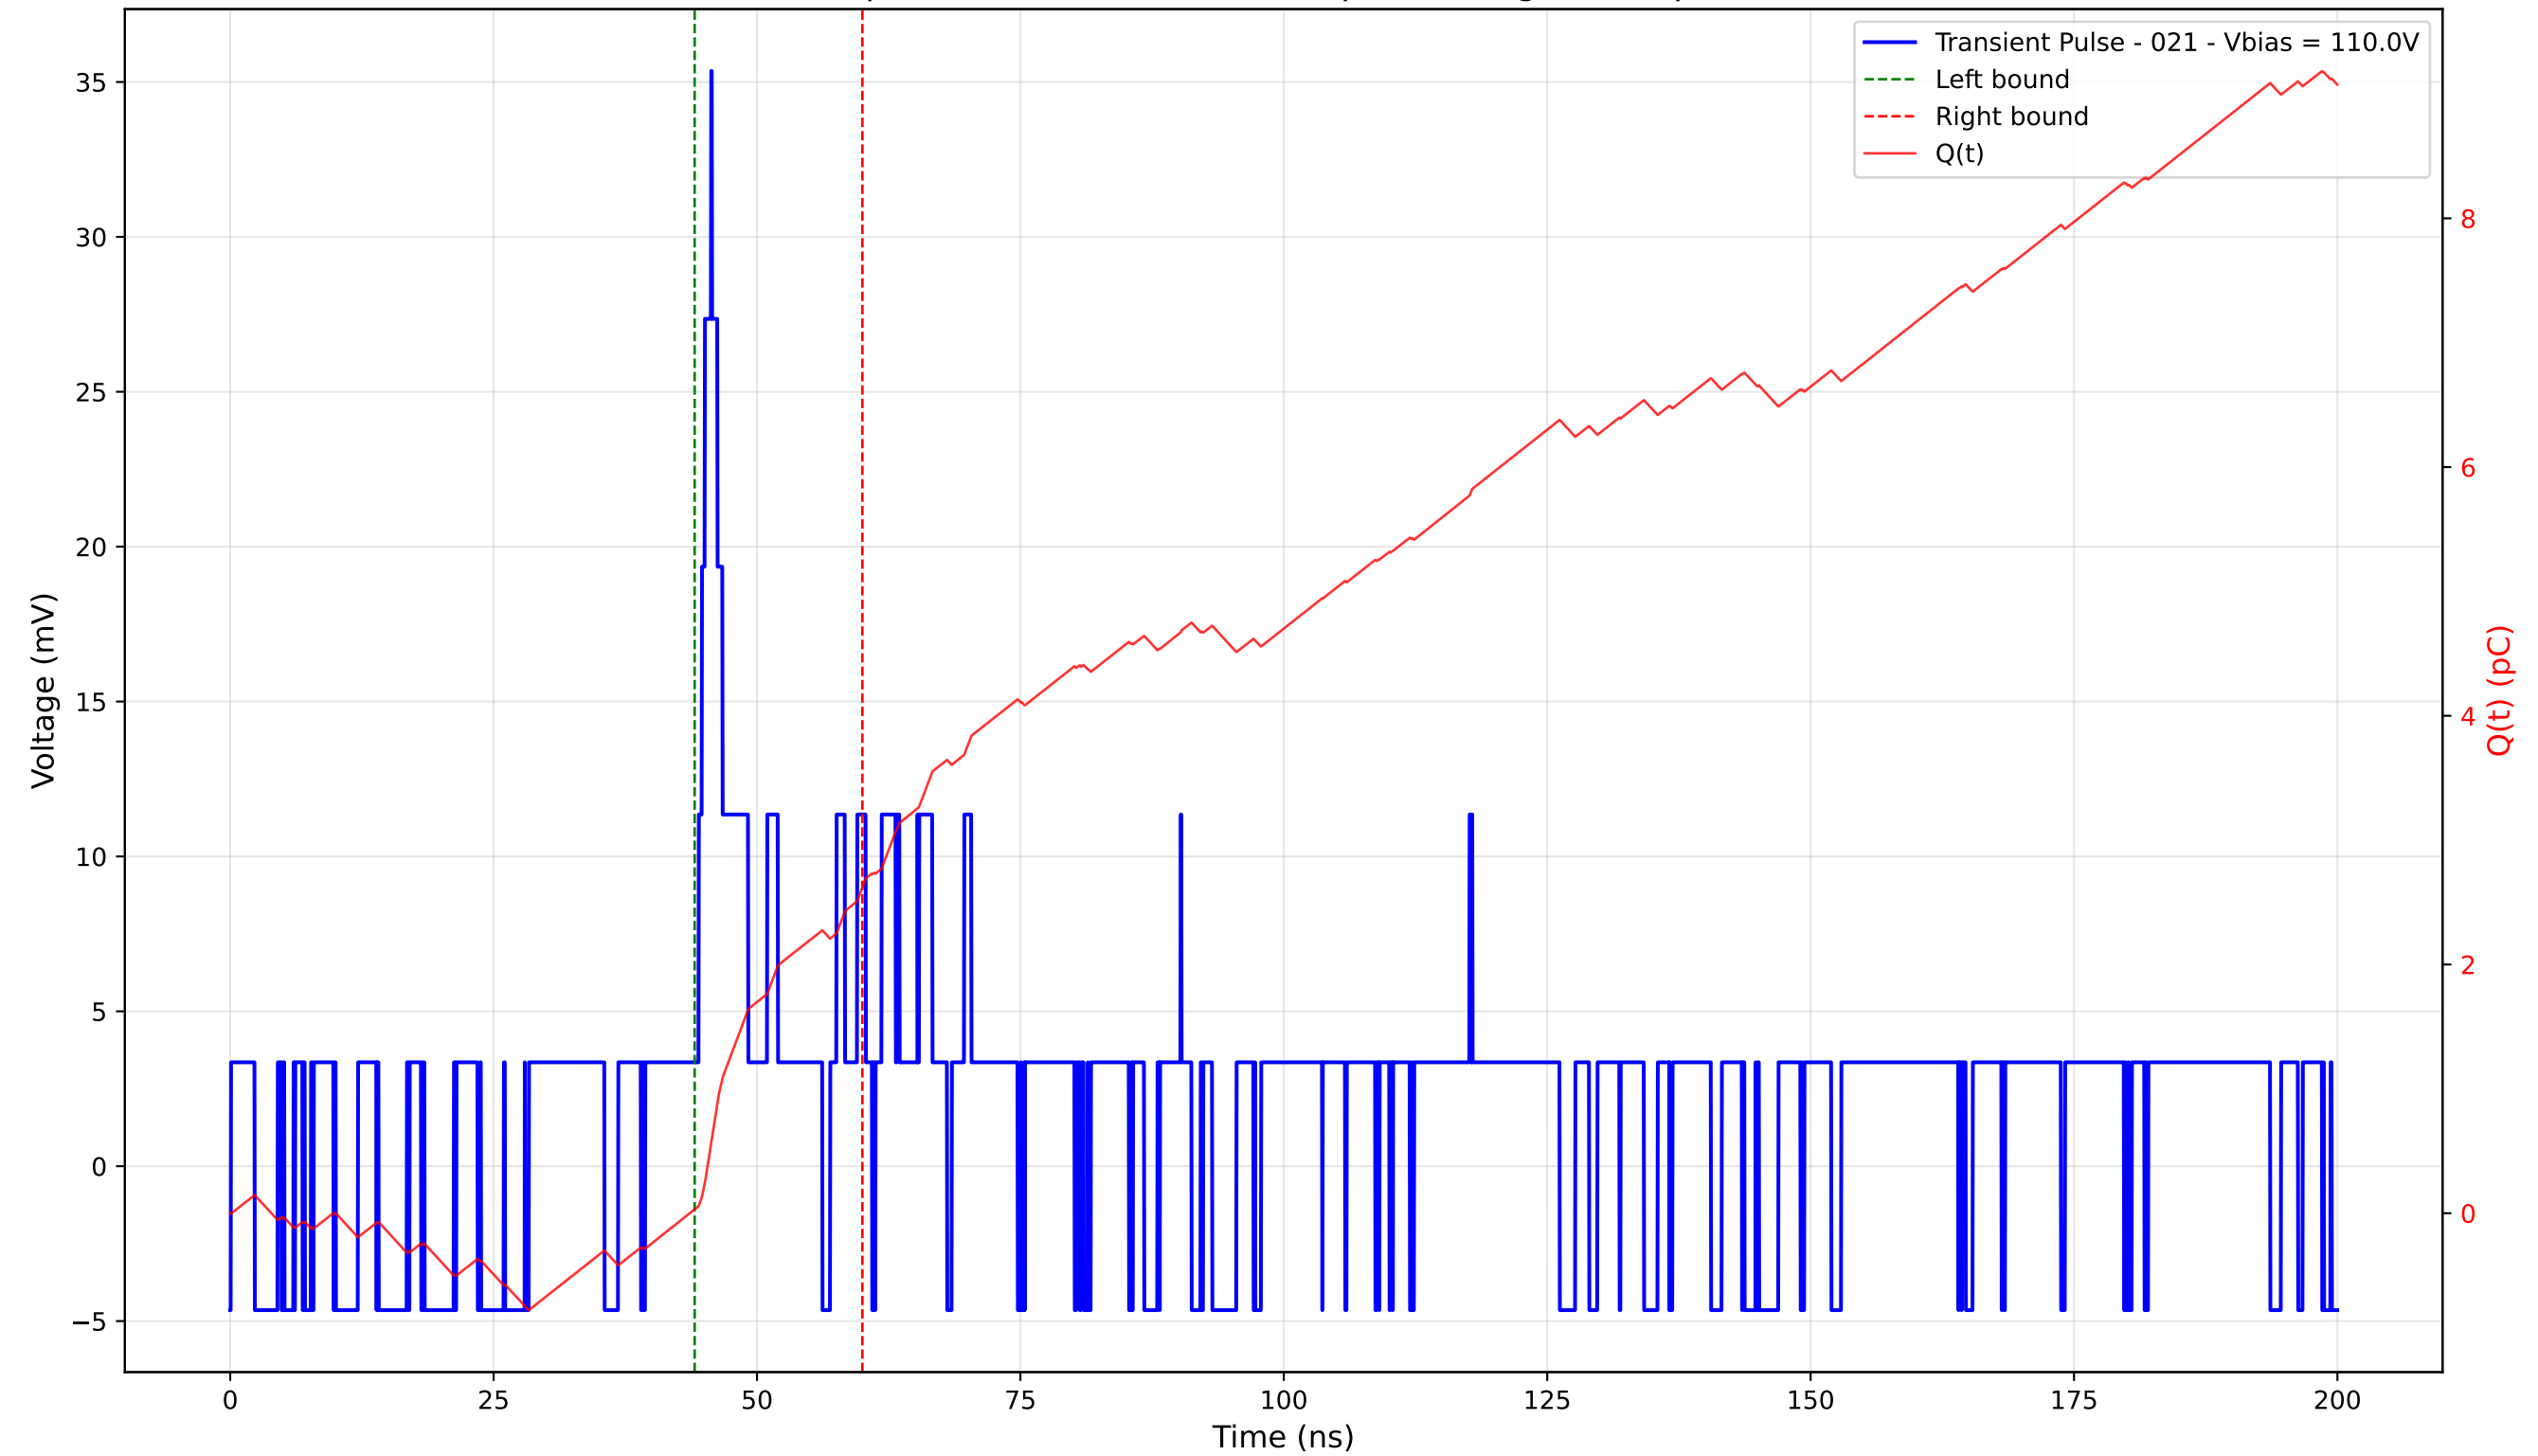


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 3.48 pC - Rise Time: 0.00 ns (N/A)

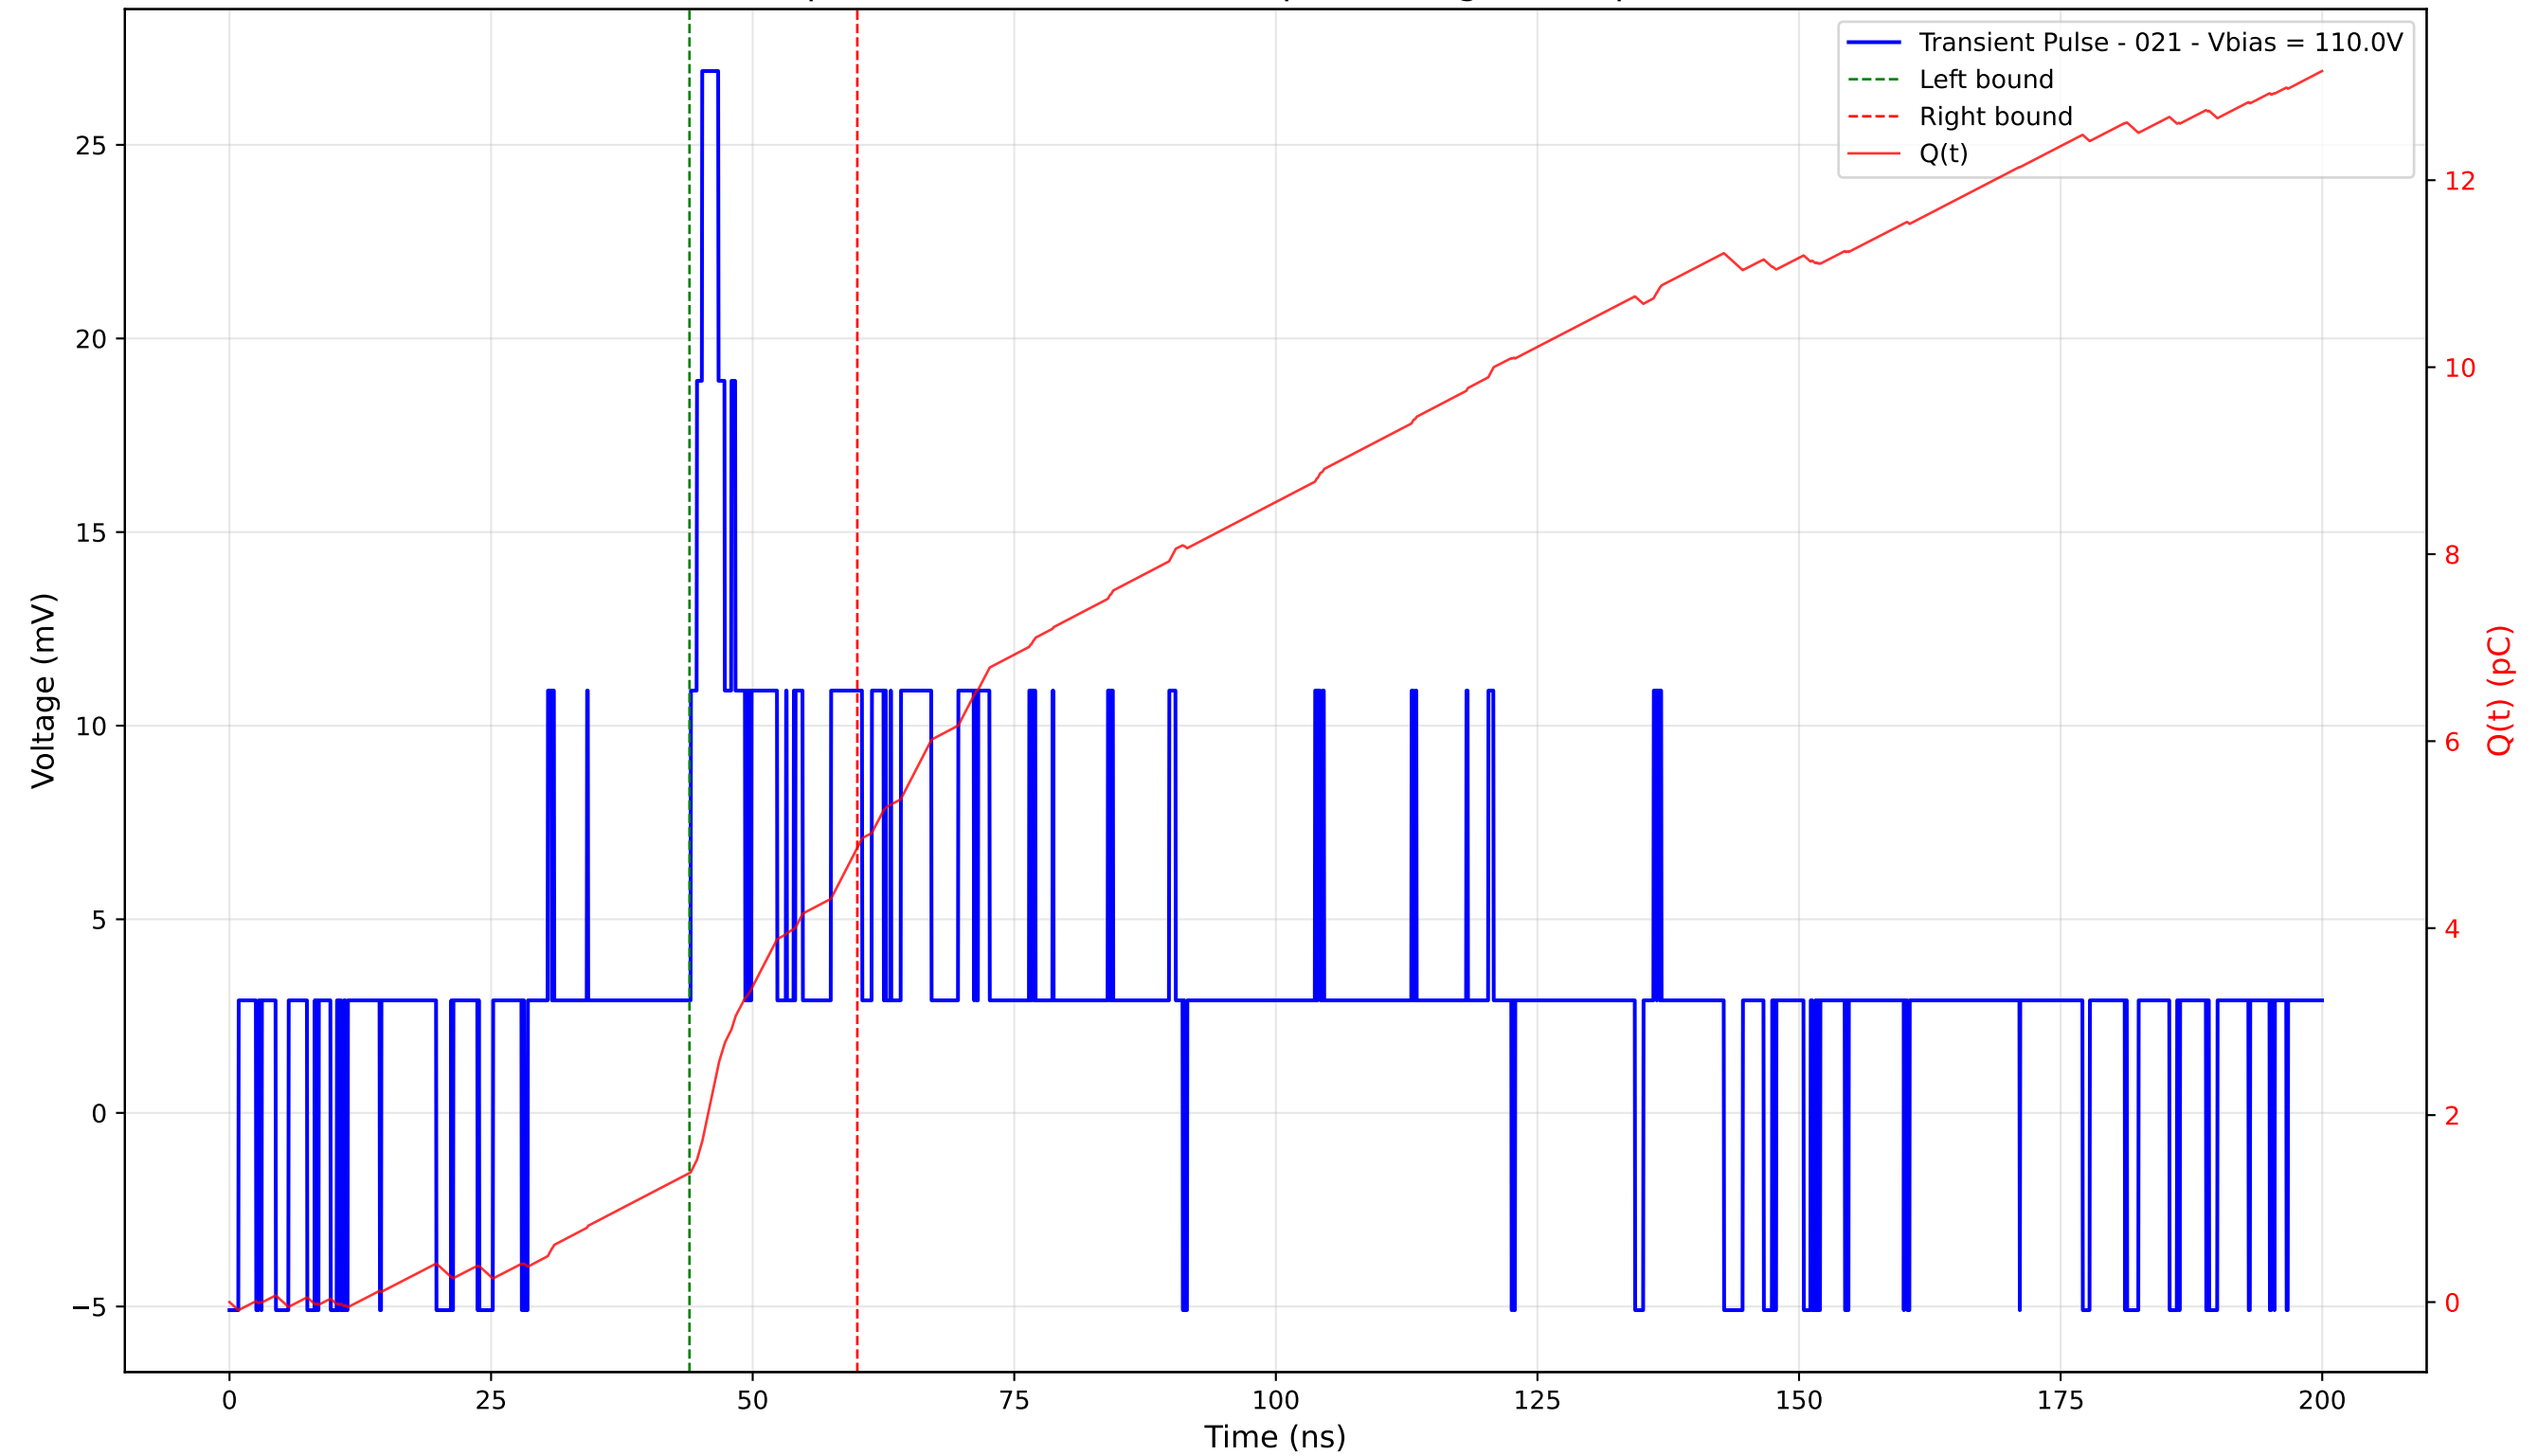


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 2.95 pC - Rise Time: 0.00 ns (N/A)

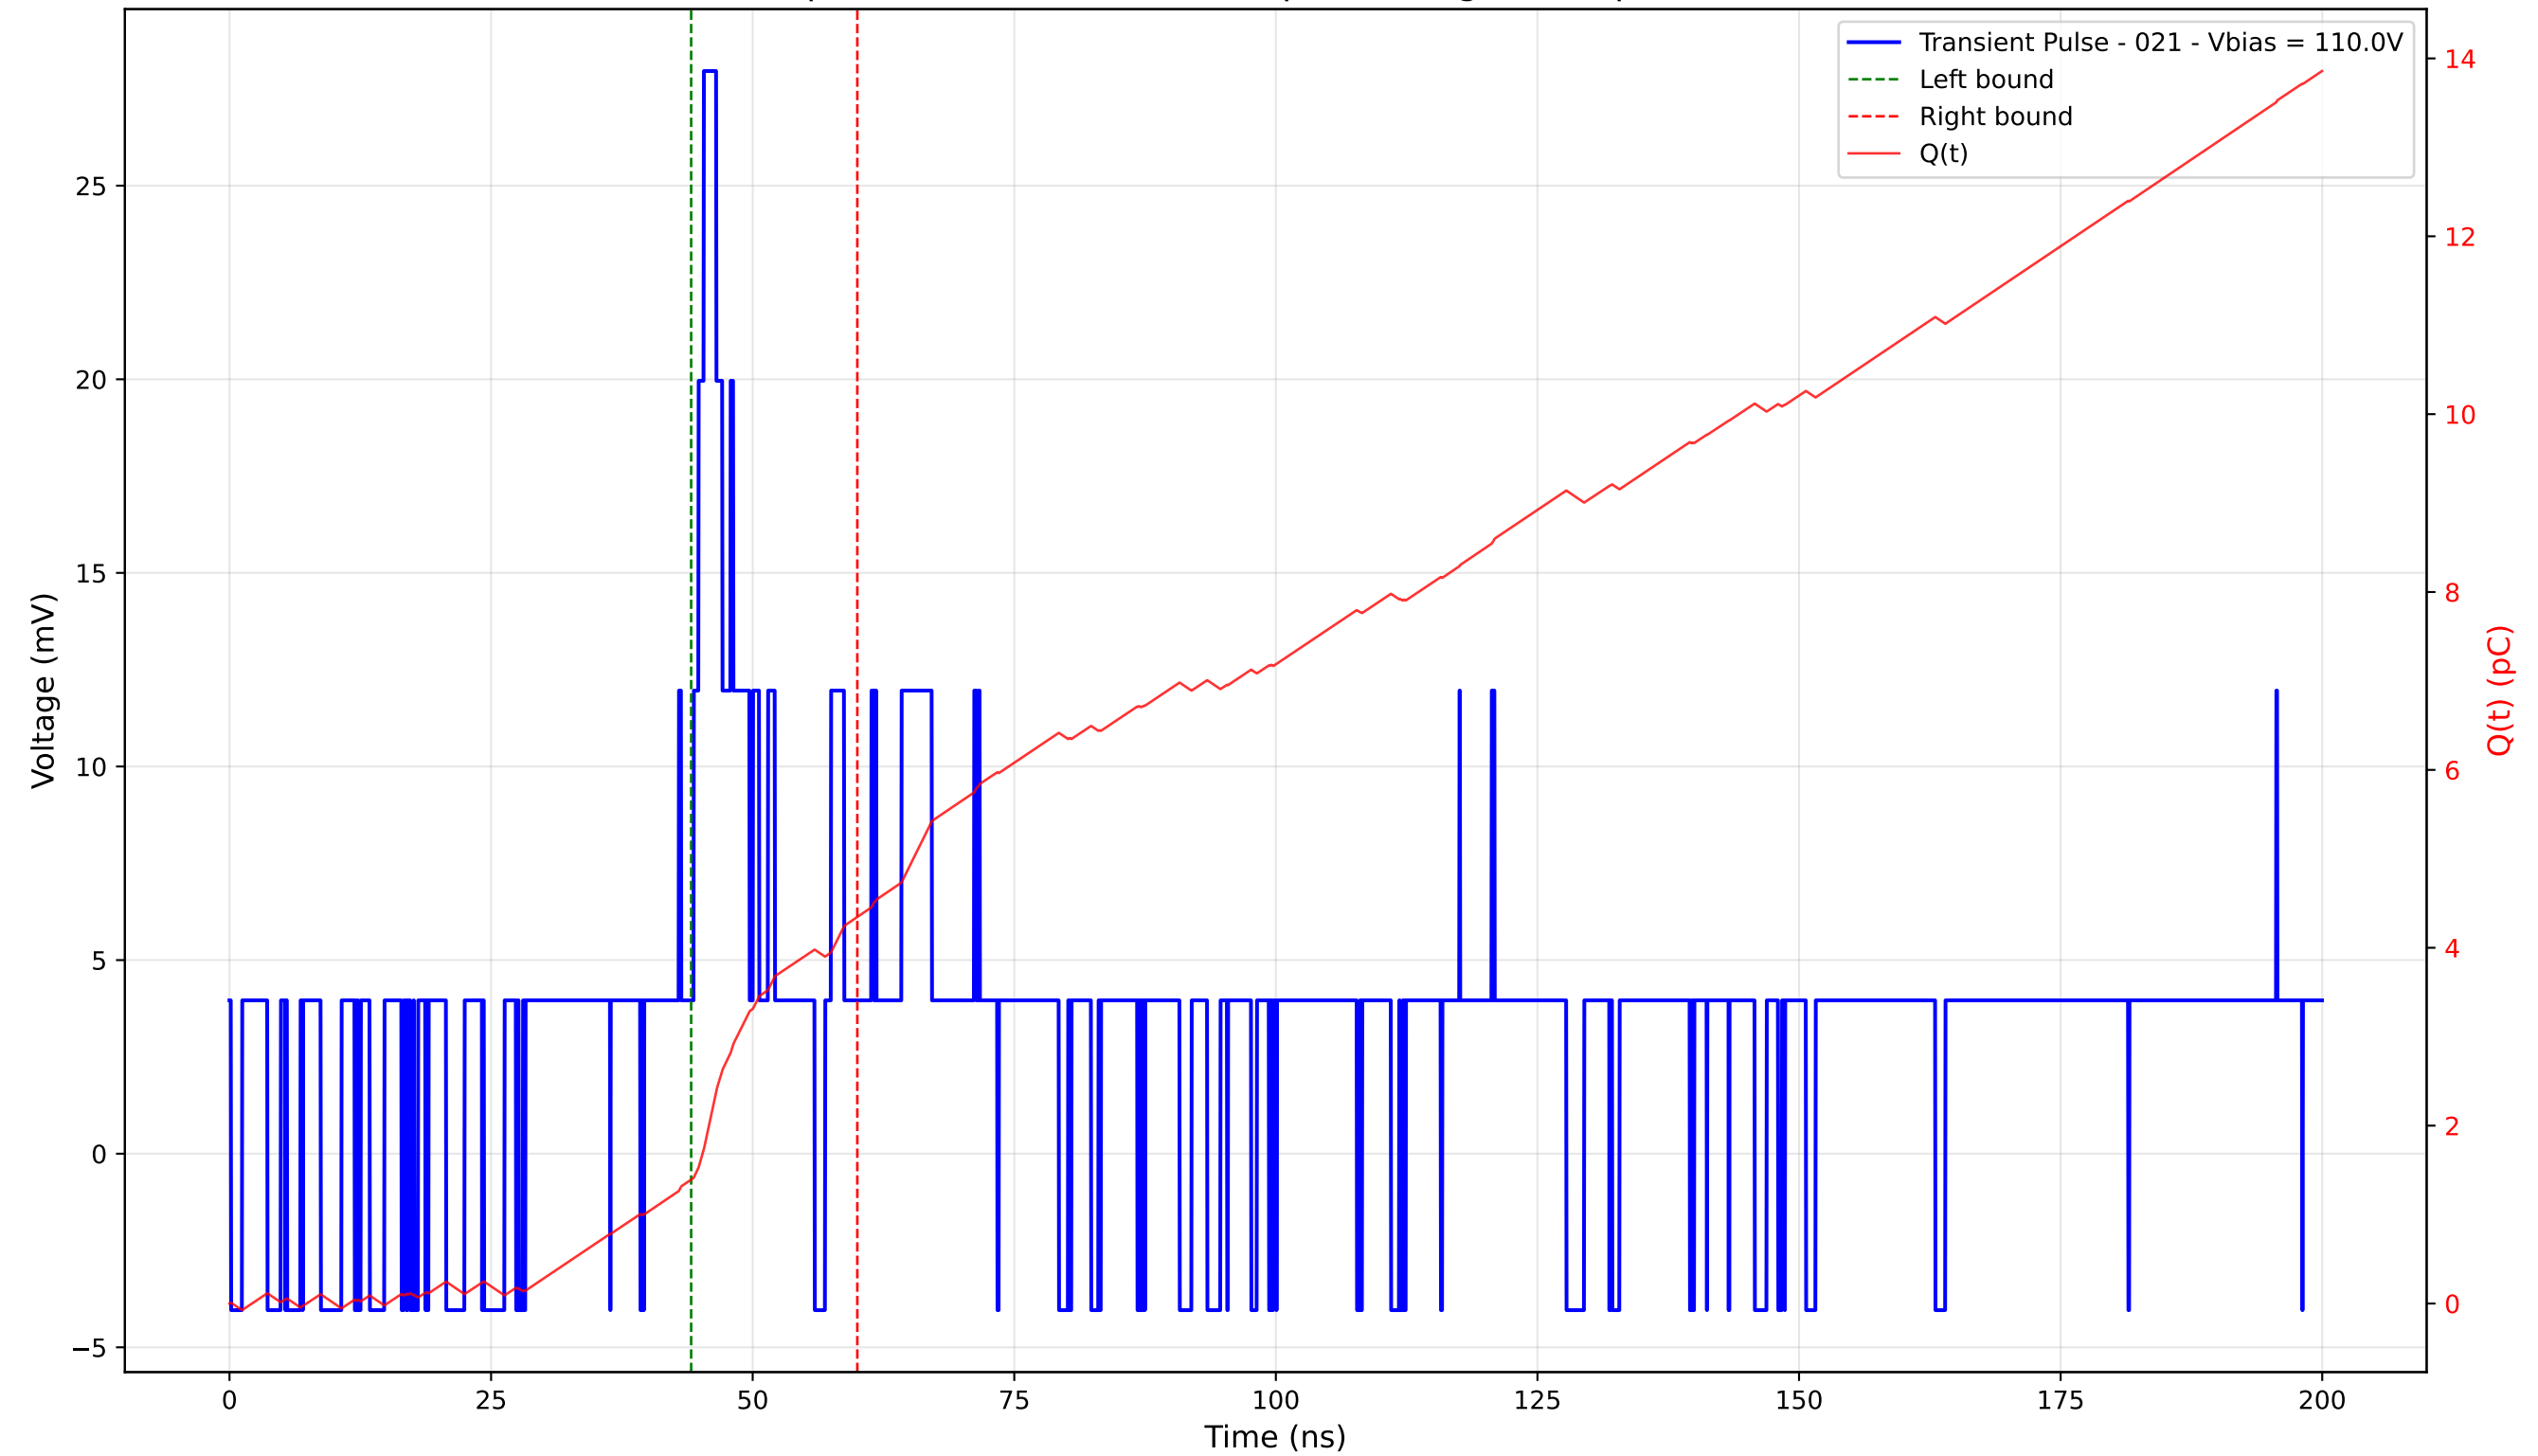


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 3.02 pC - Rise Time: 4.06 ns

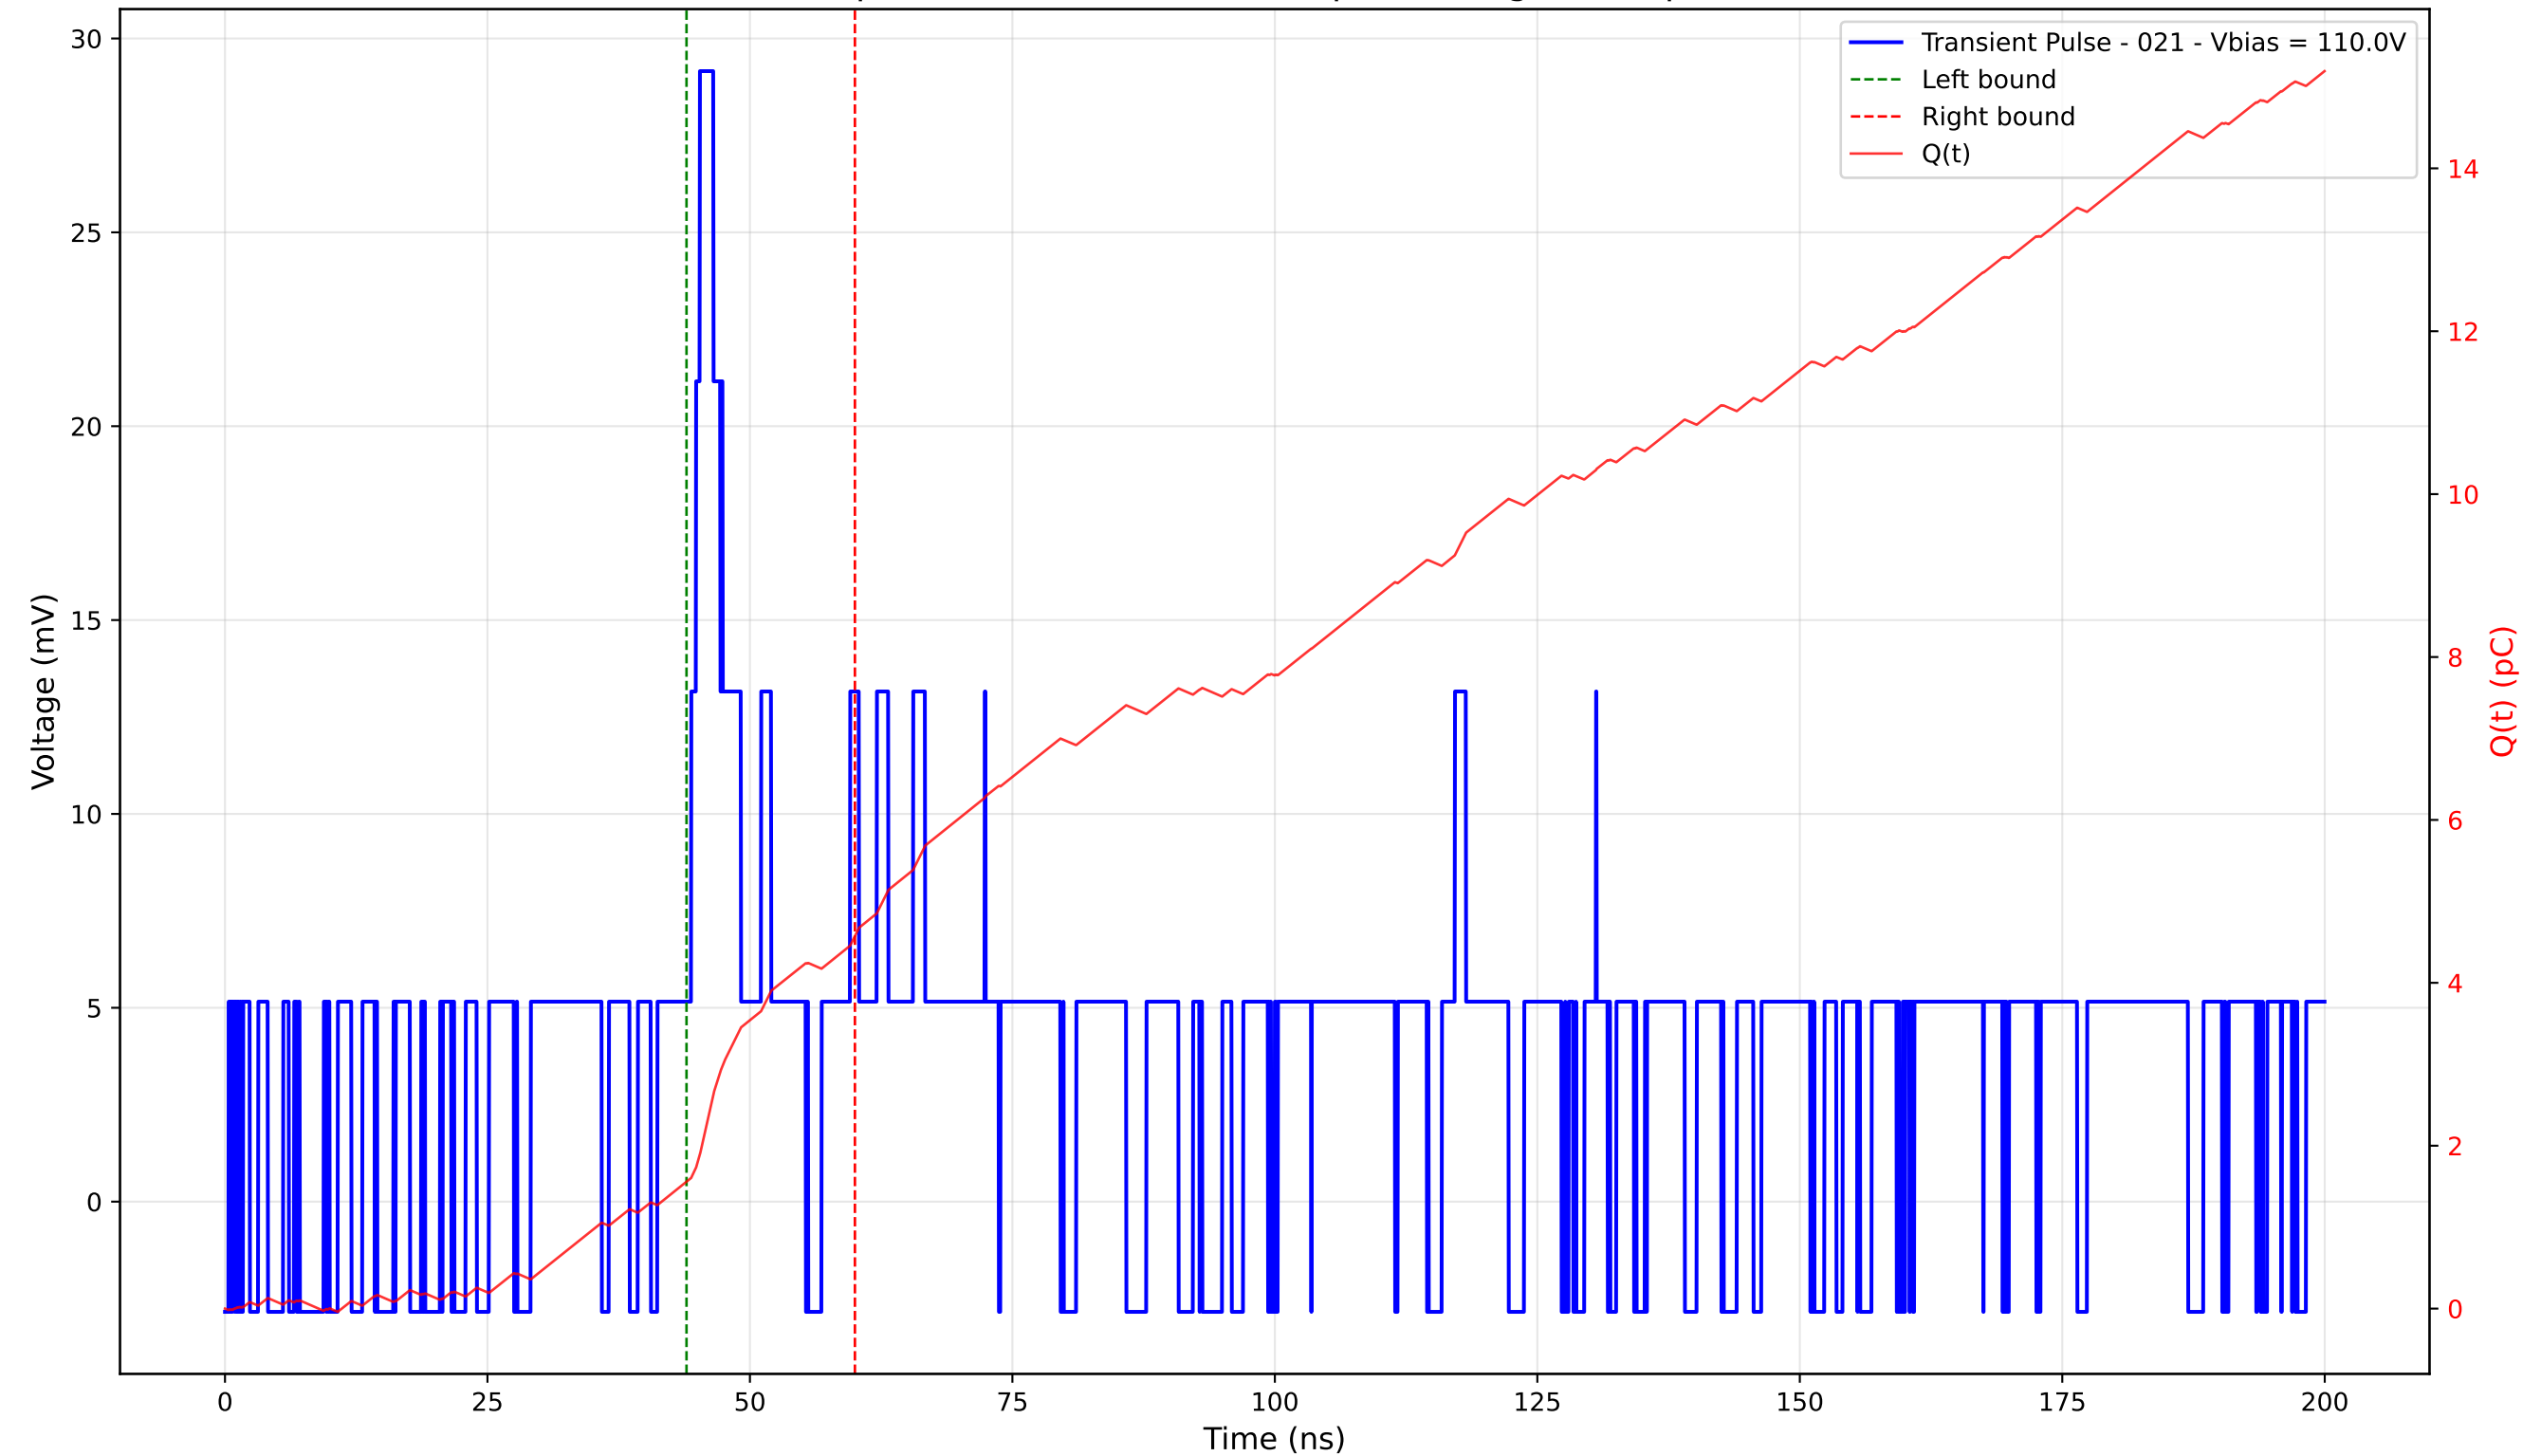


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 2.88 pC - Rise Time: 1.20 ns

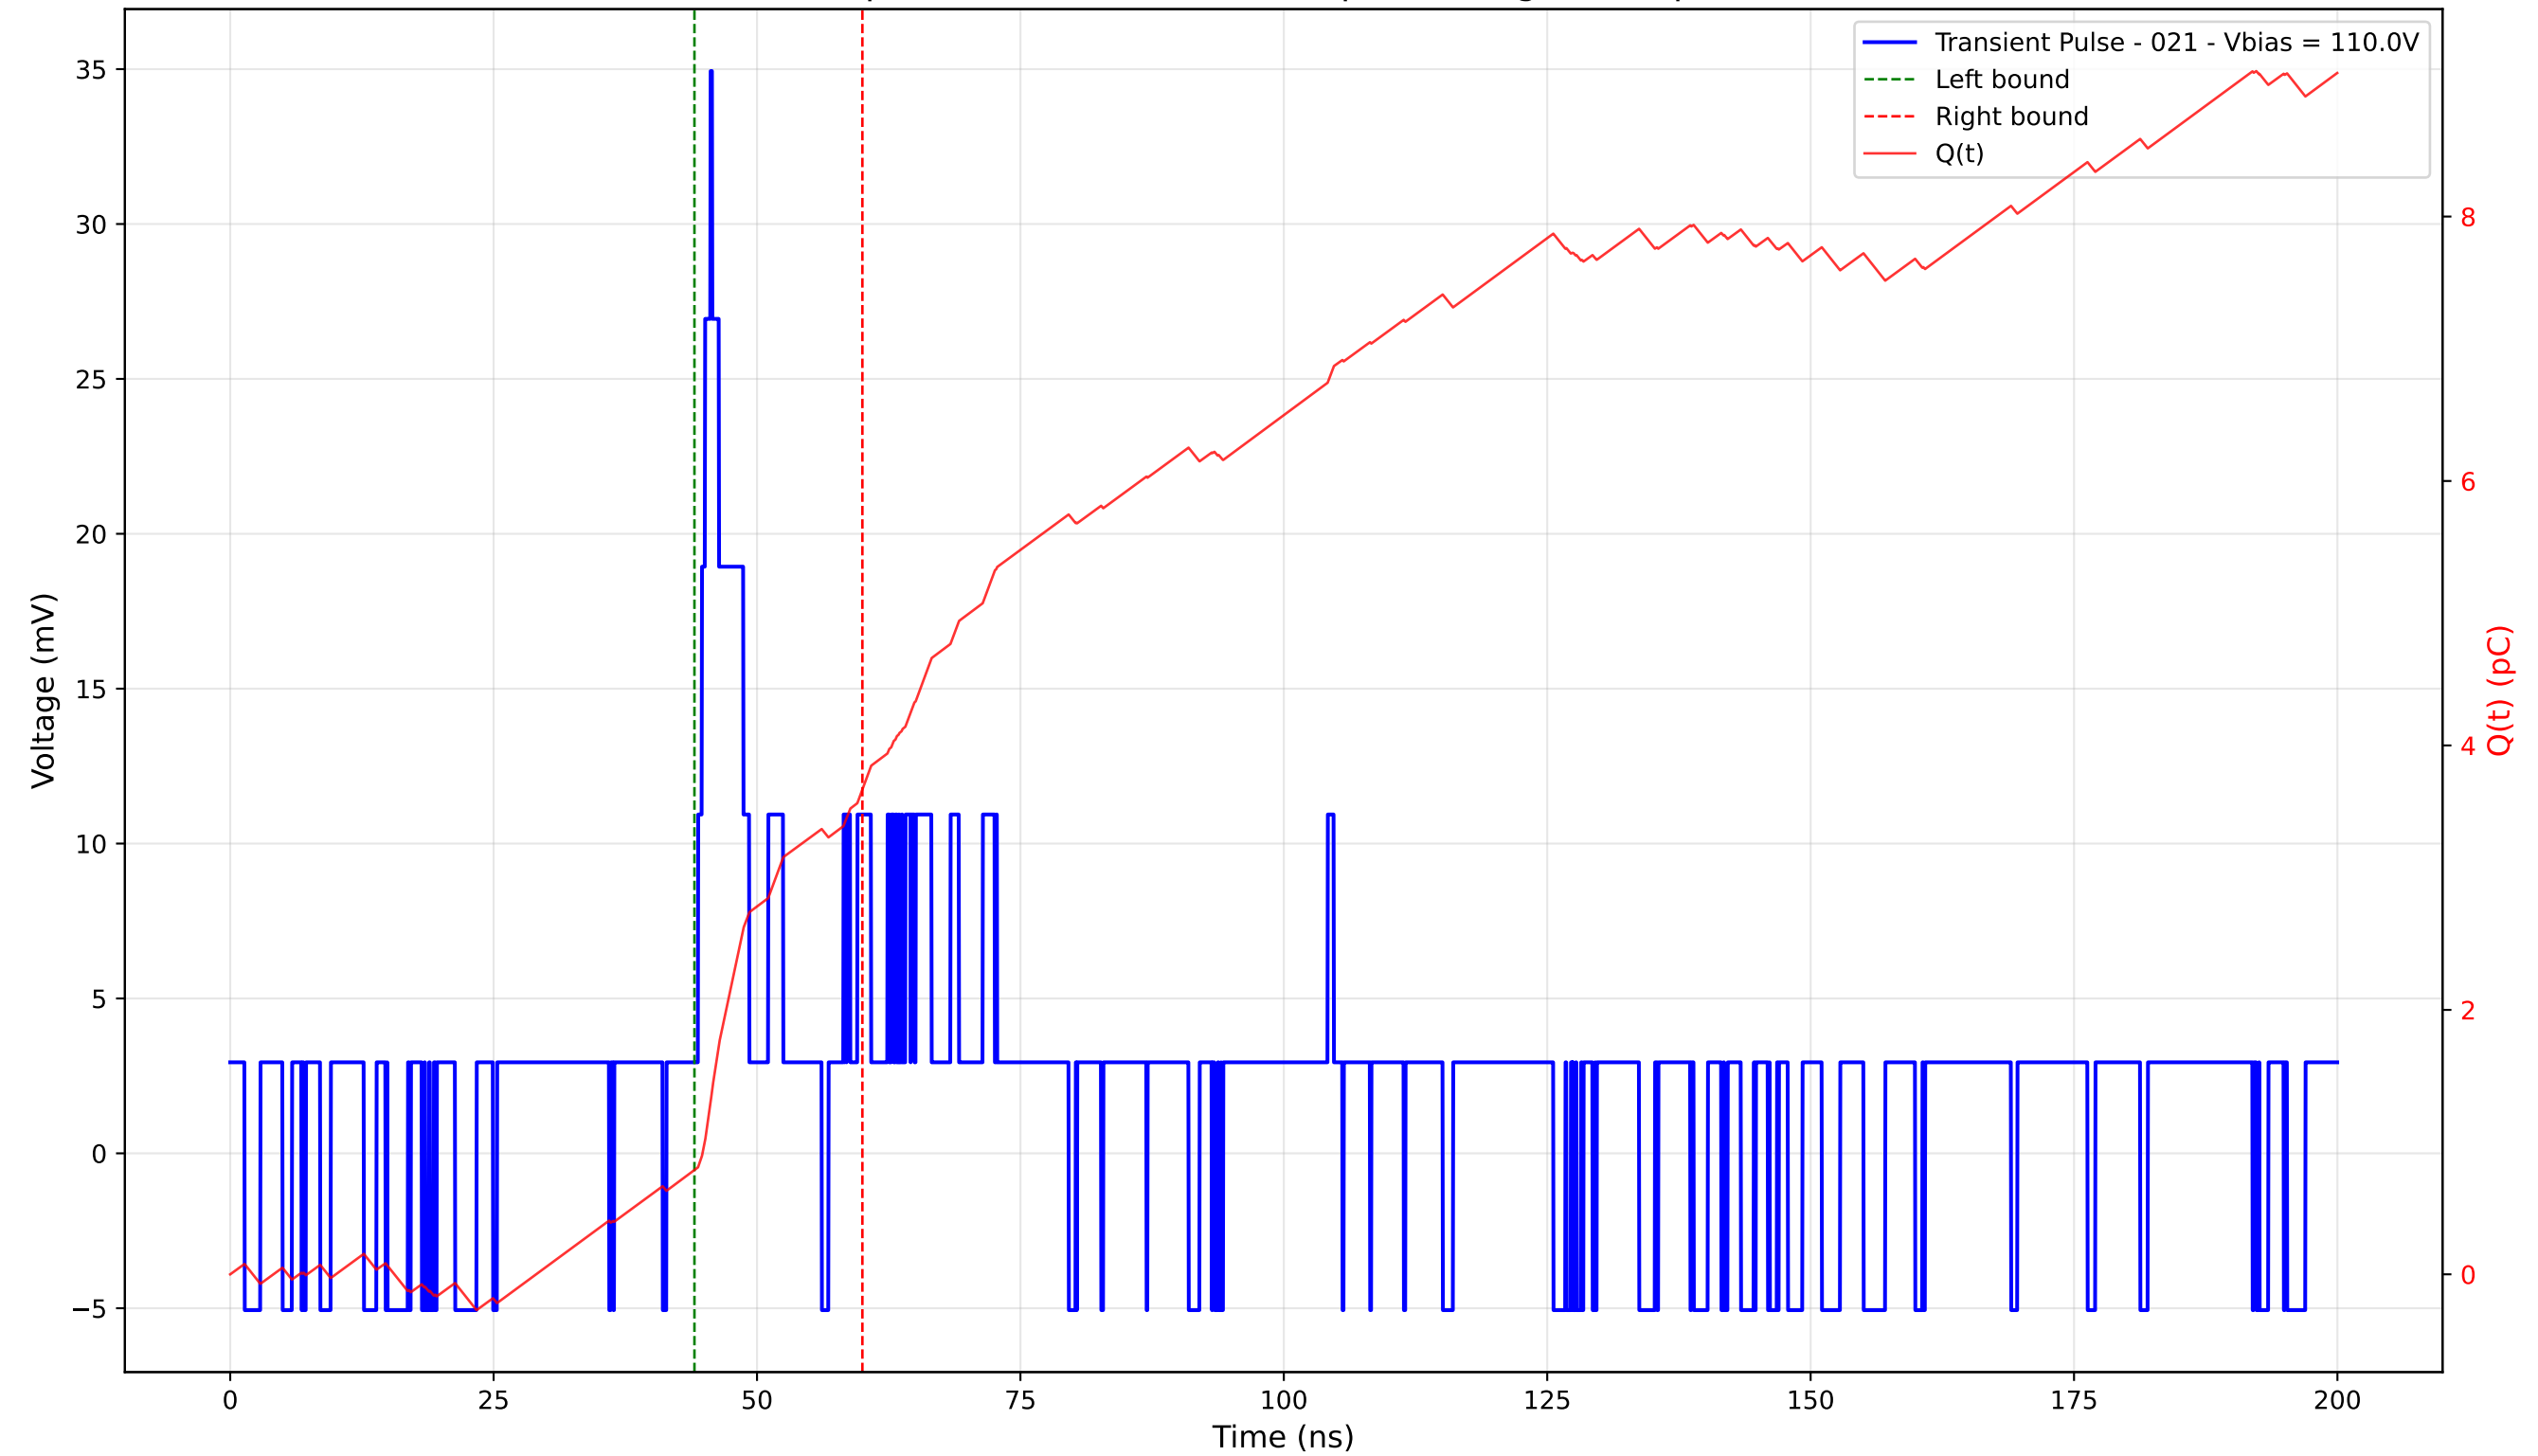


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.15 pC - Rise Time: 0.58 ns

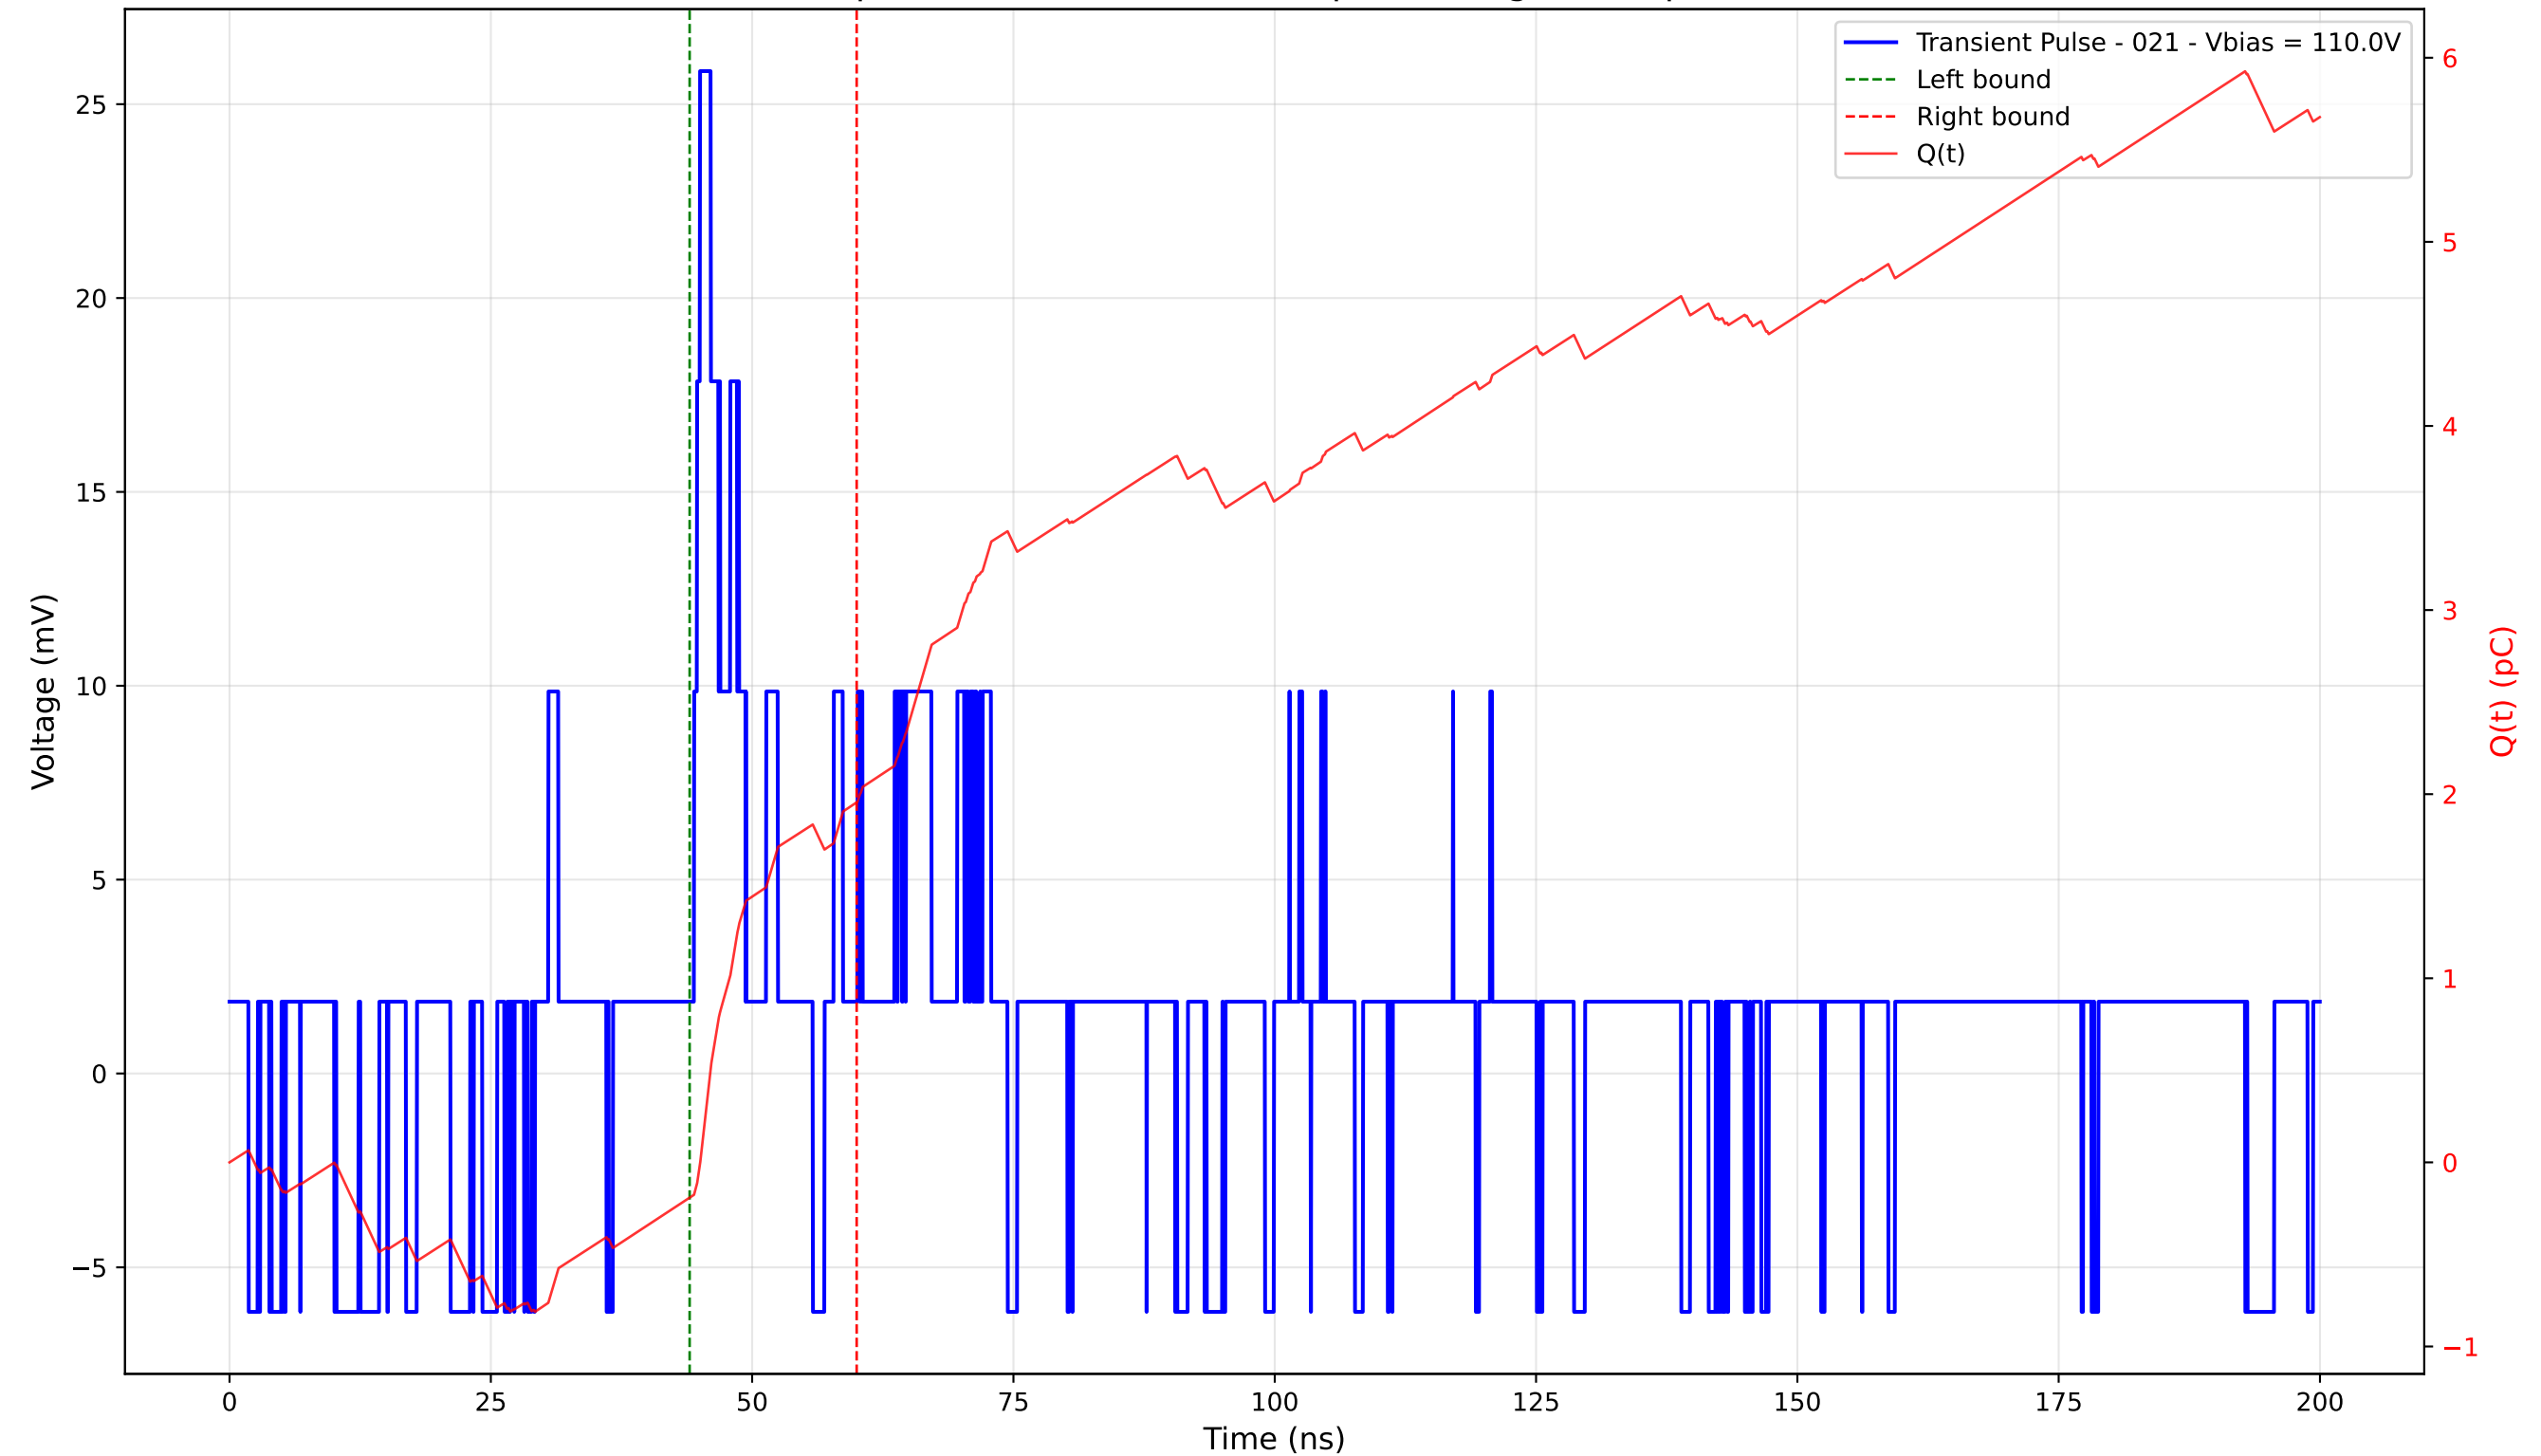


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 2.46 pC - Rise Time: 1.04 ns

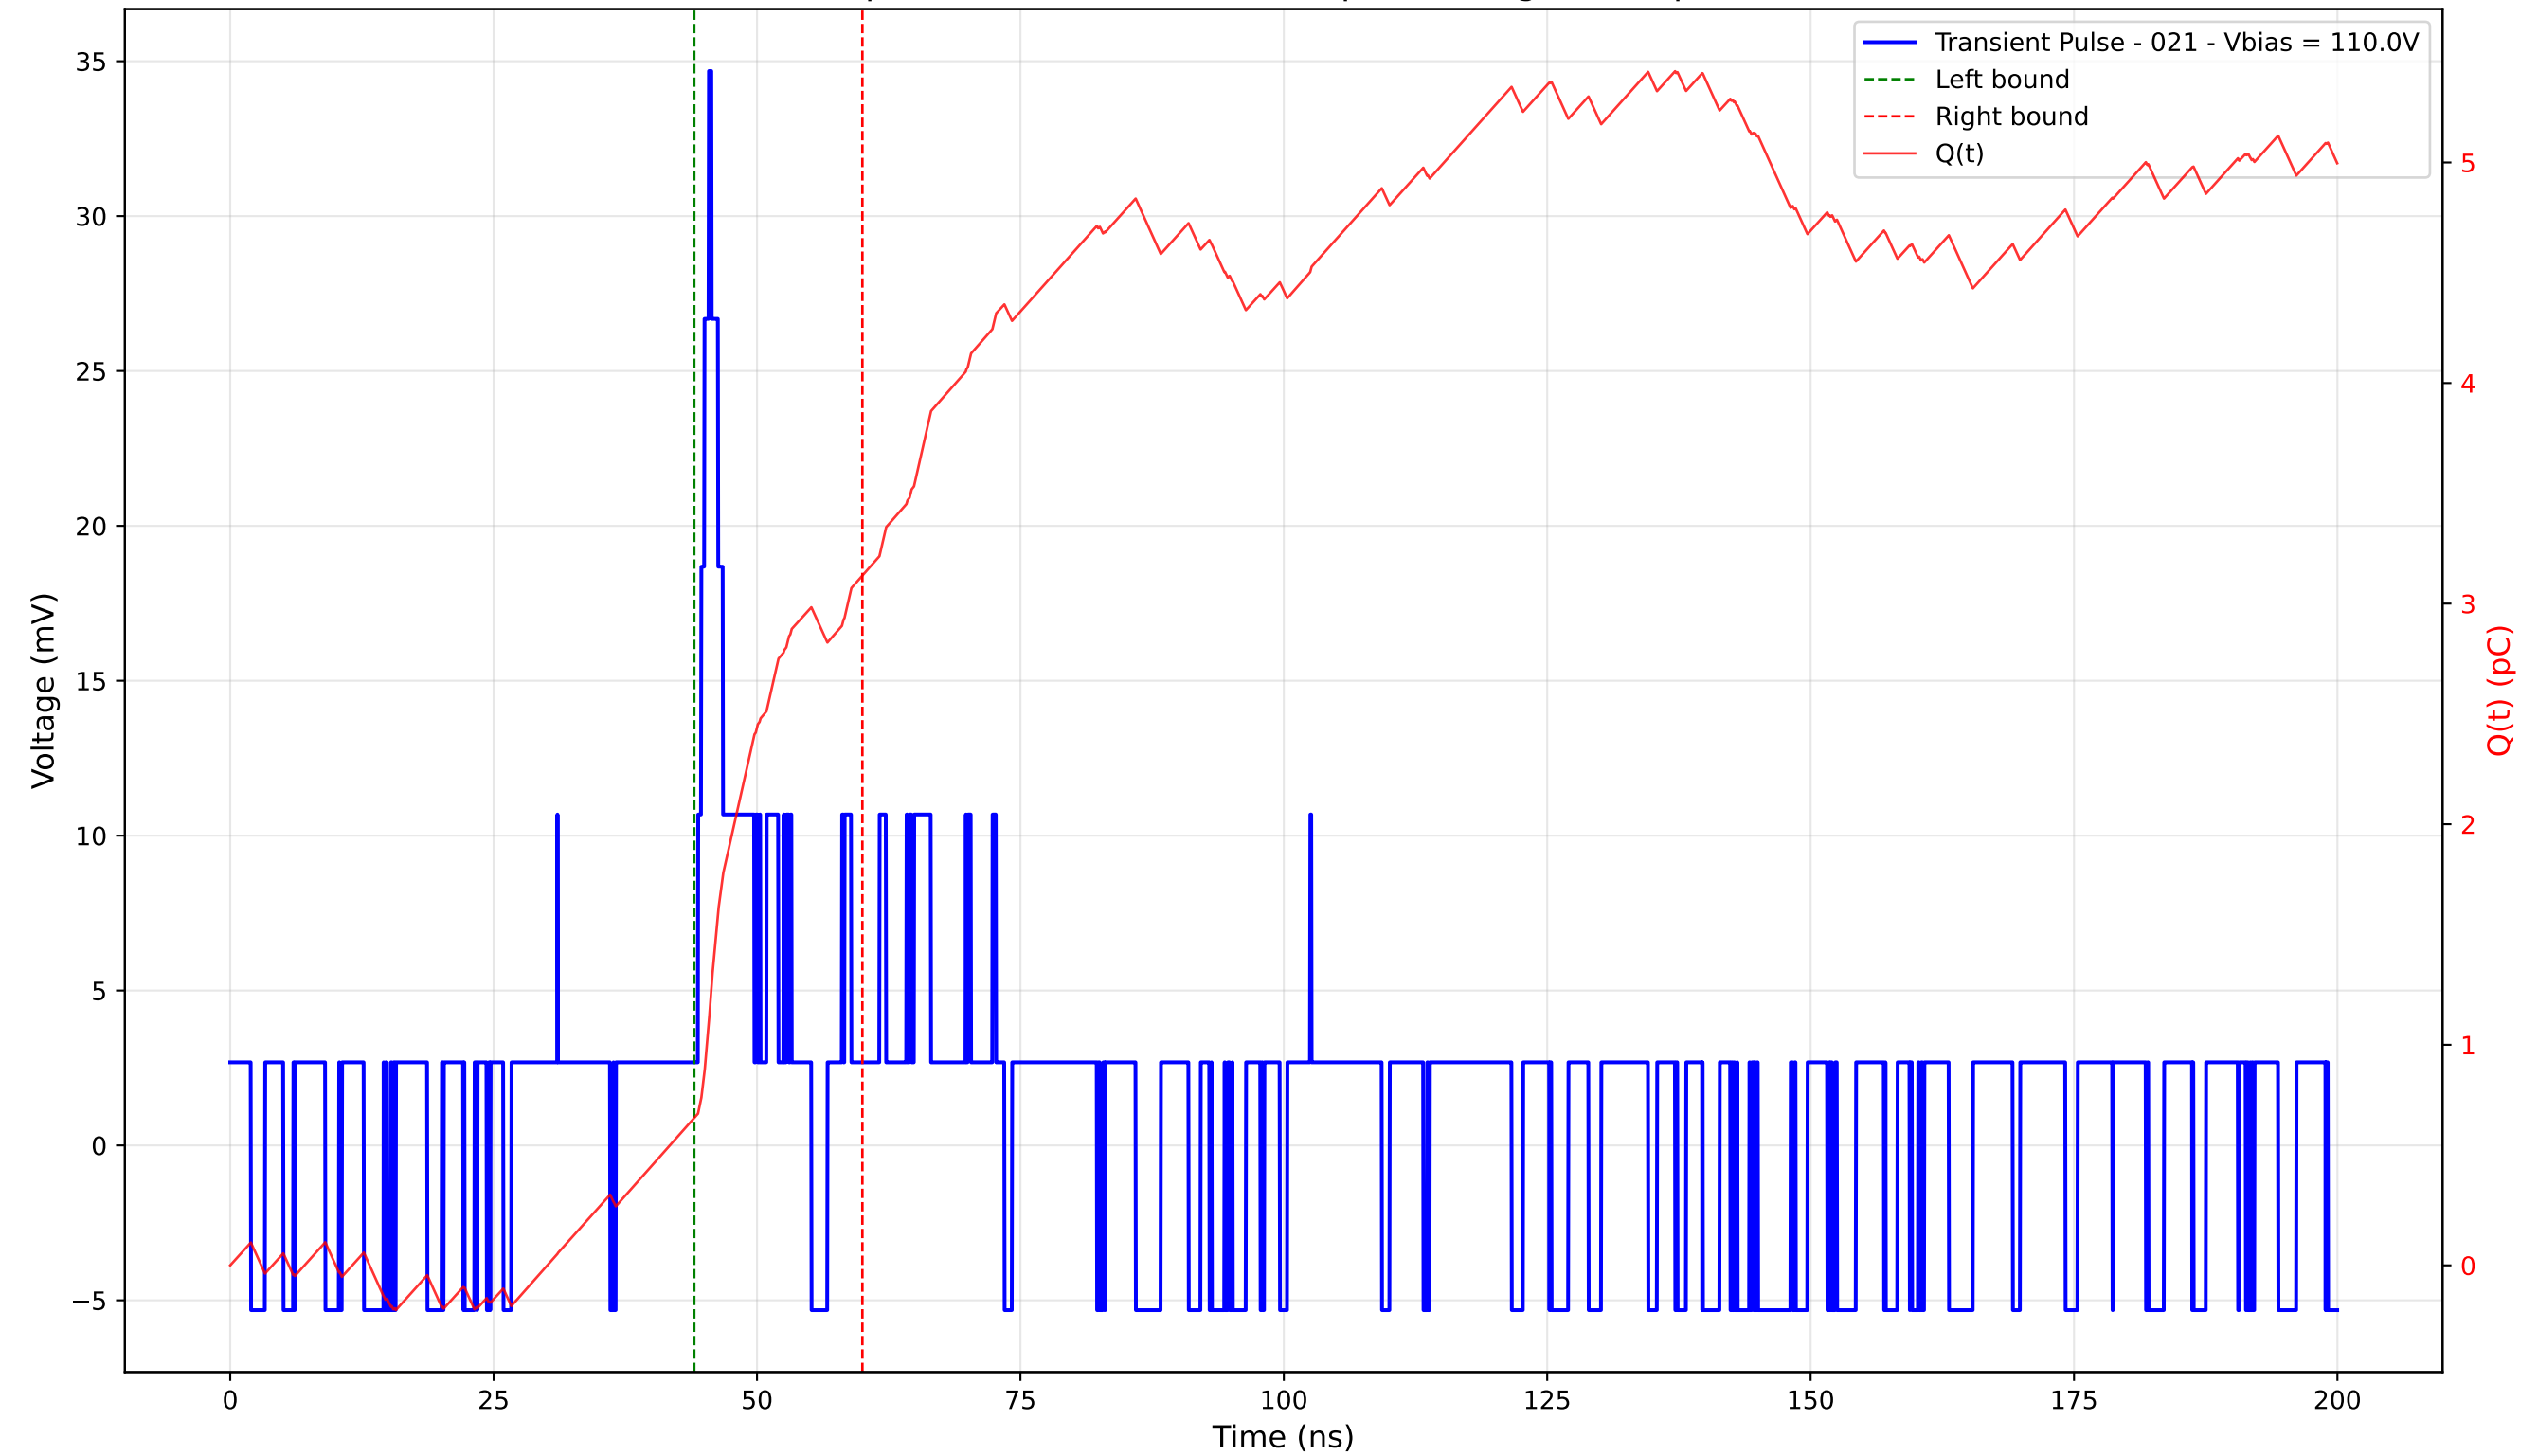


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 2.81 pC - Rise Time: 0.97 ns

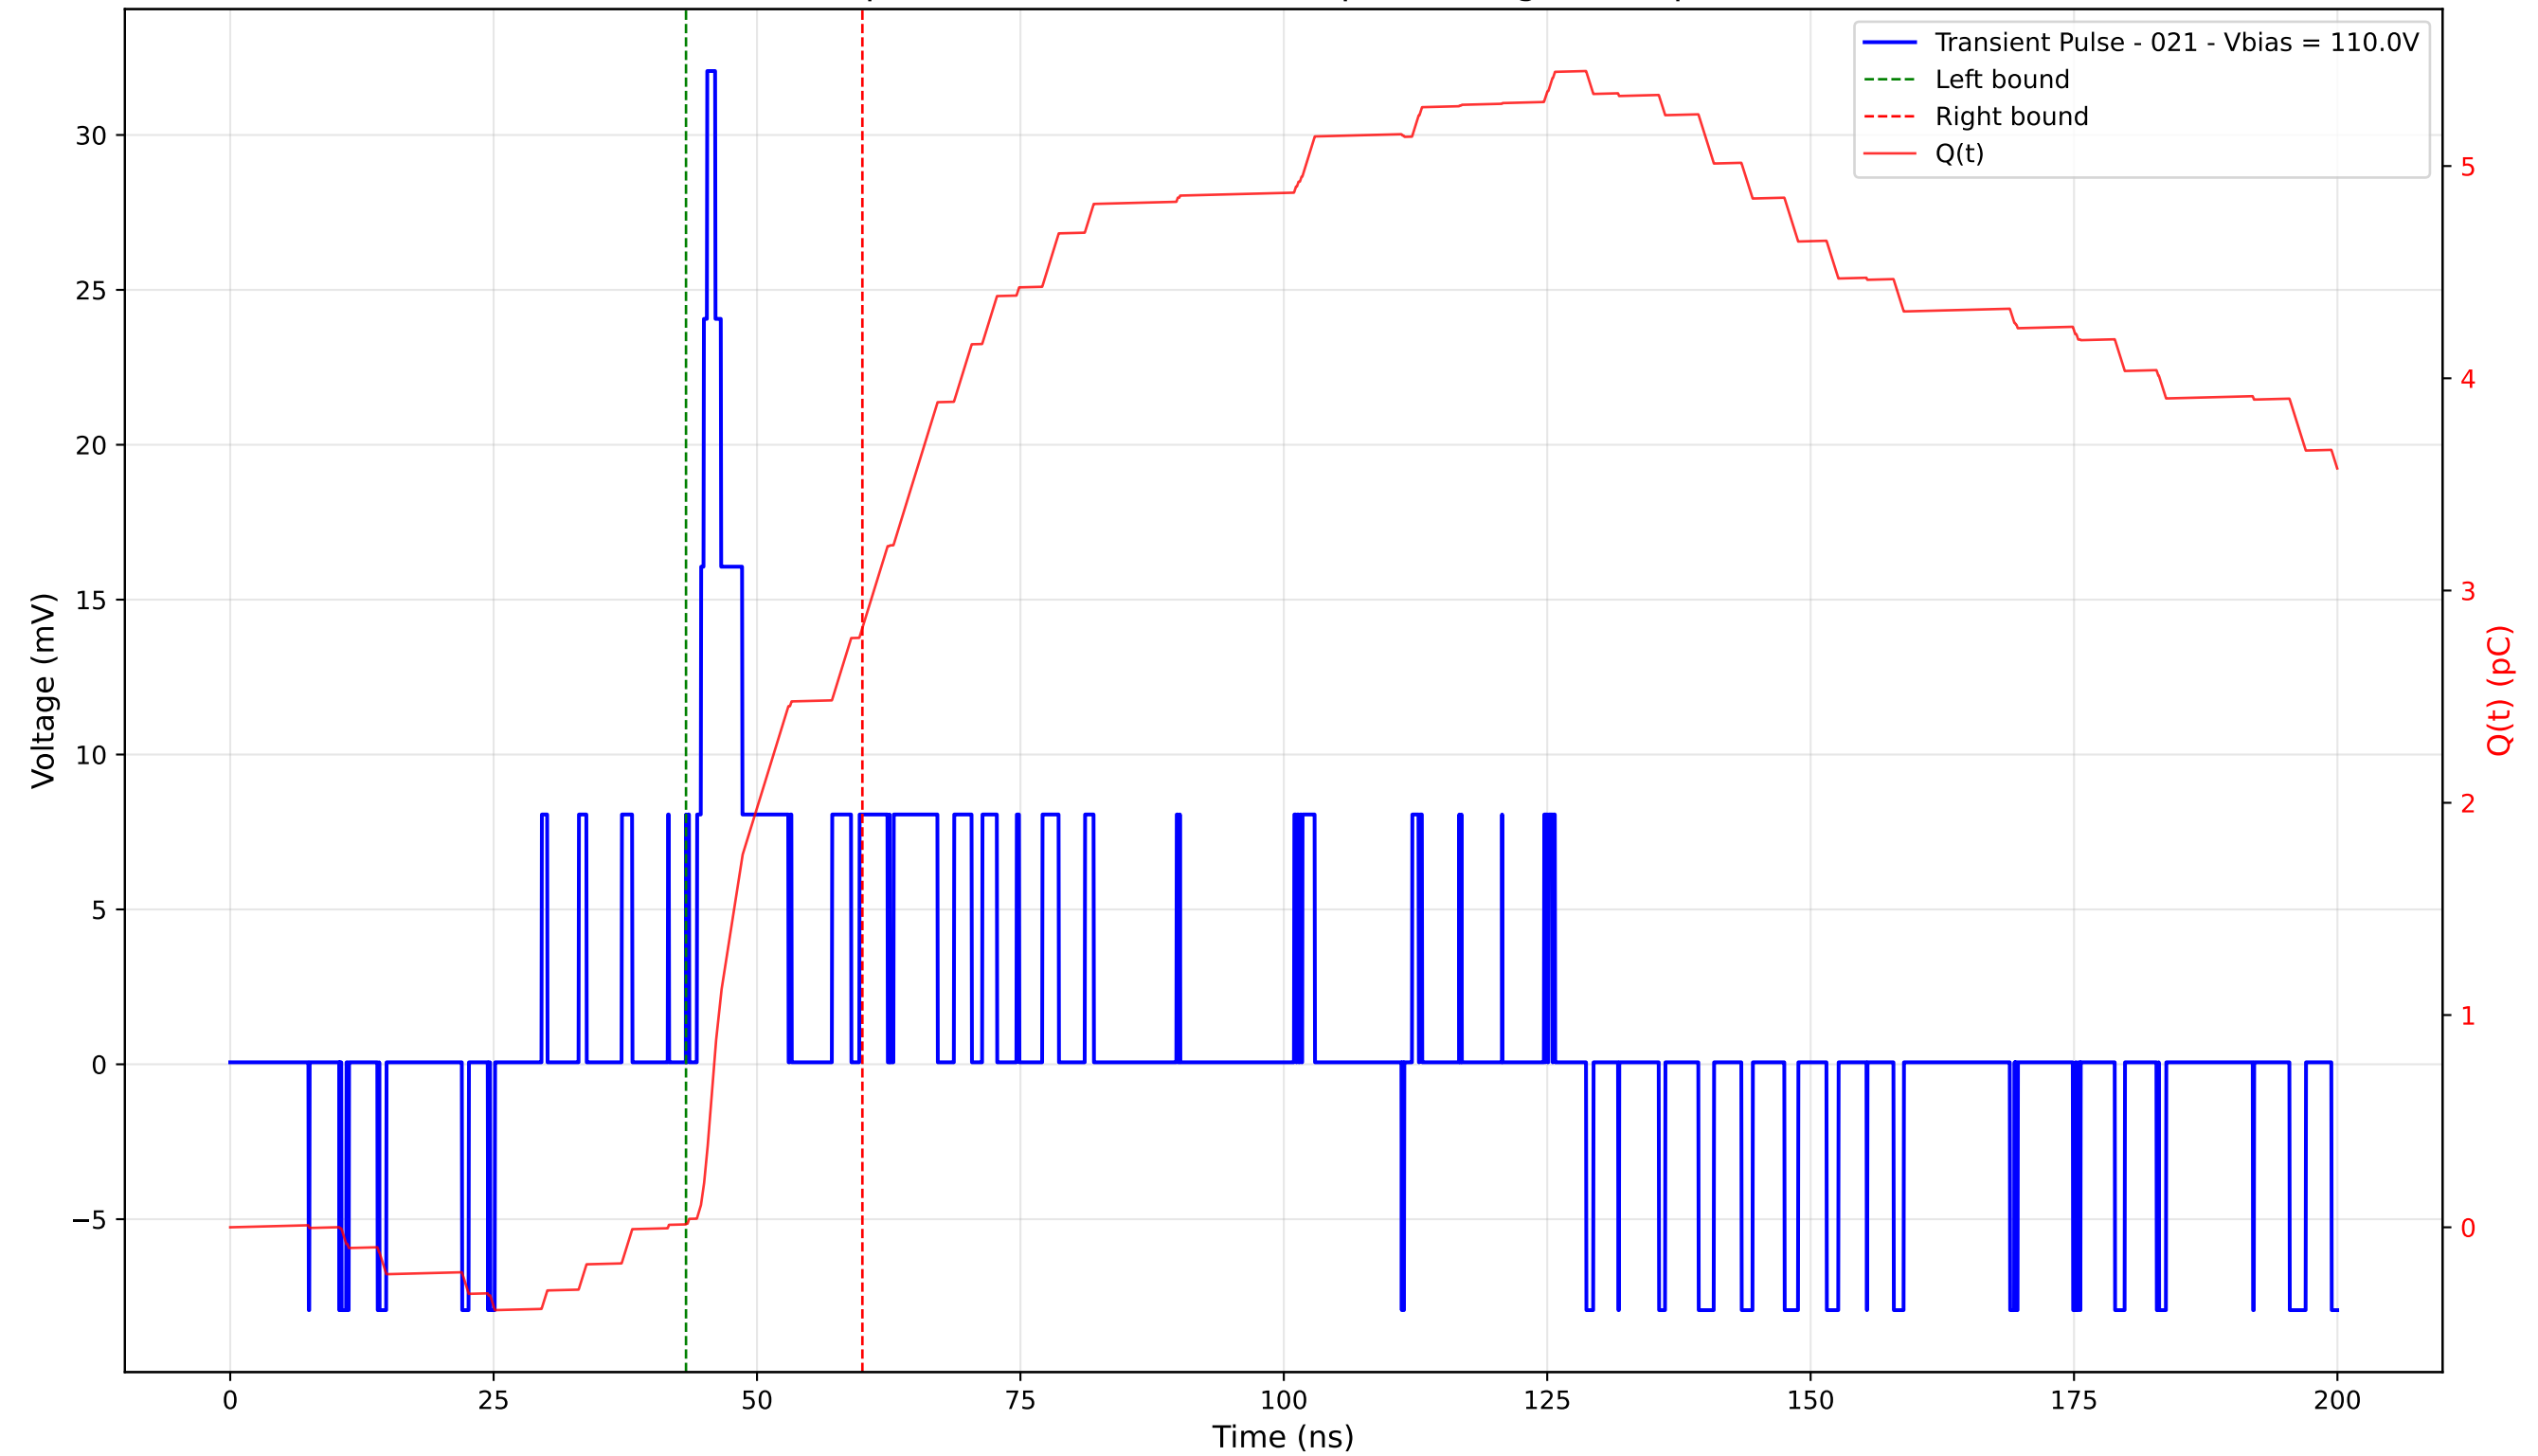


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 3.09 pC - Rise Time: 1.03 ns

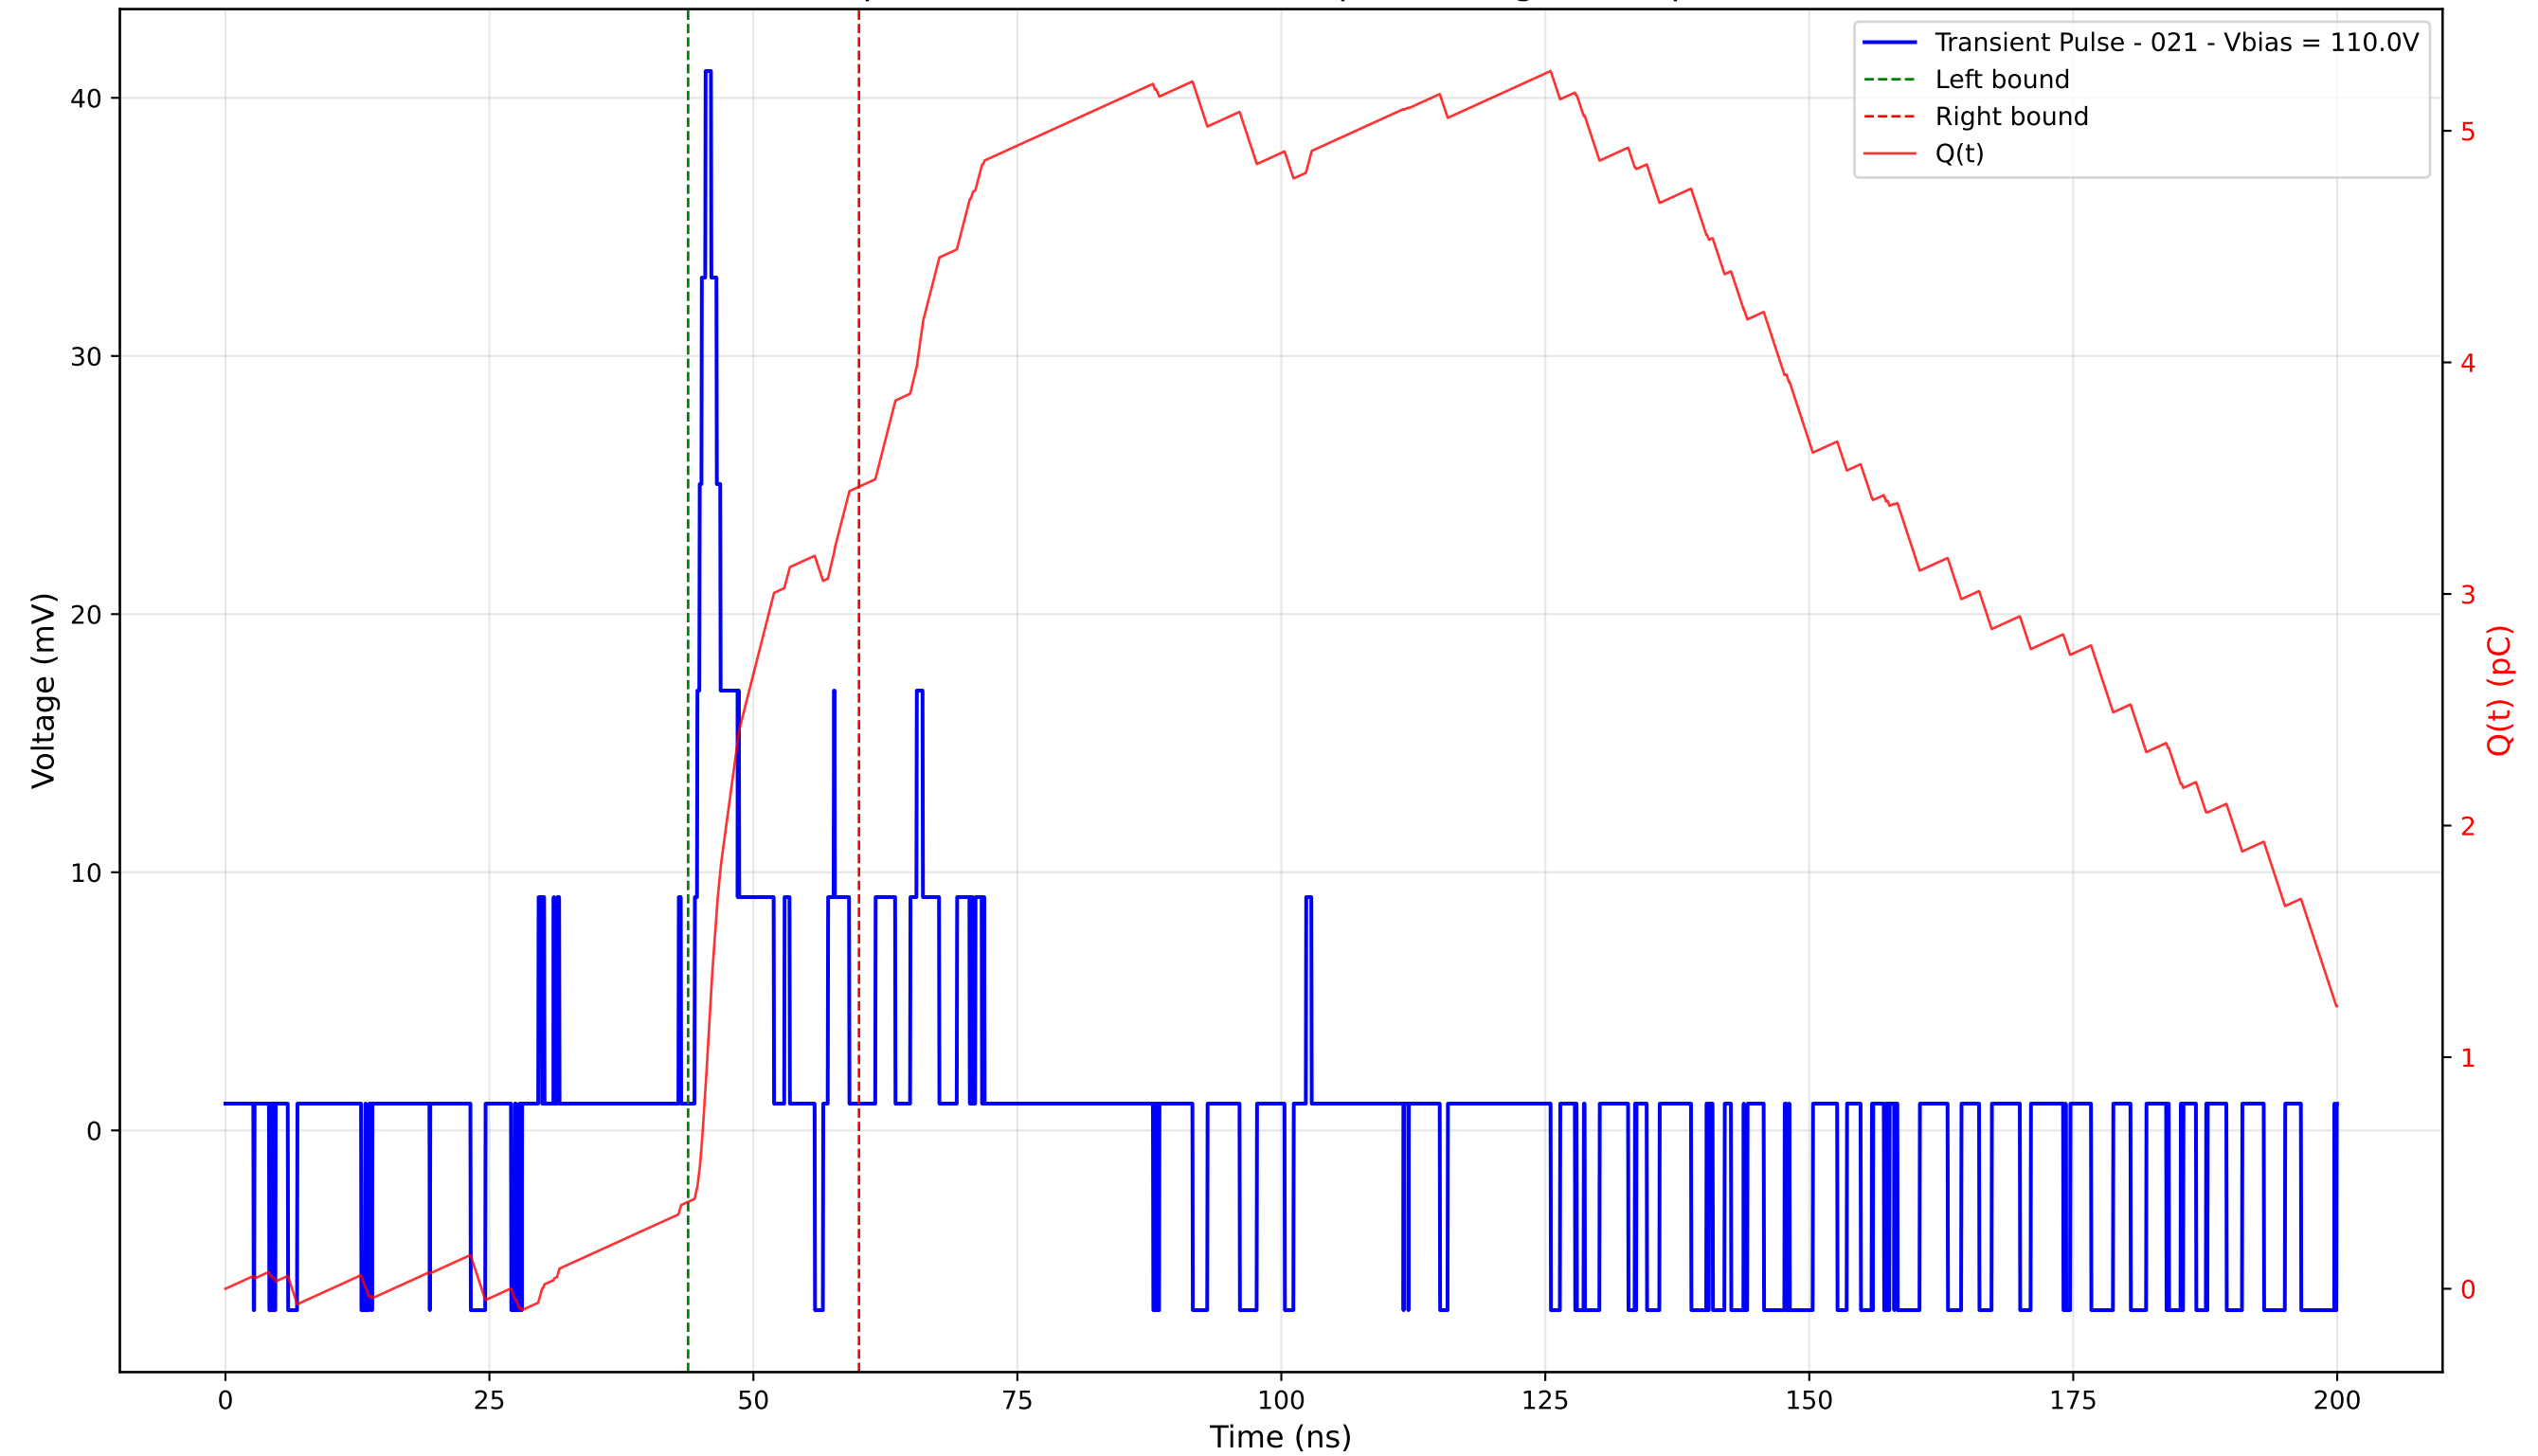


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 3.31 pC - Rise Time: 1.32 ns

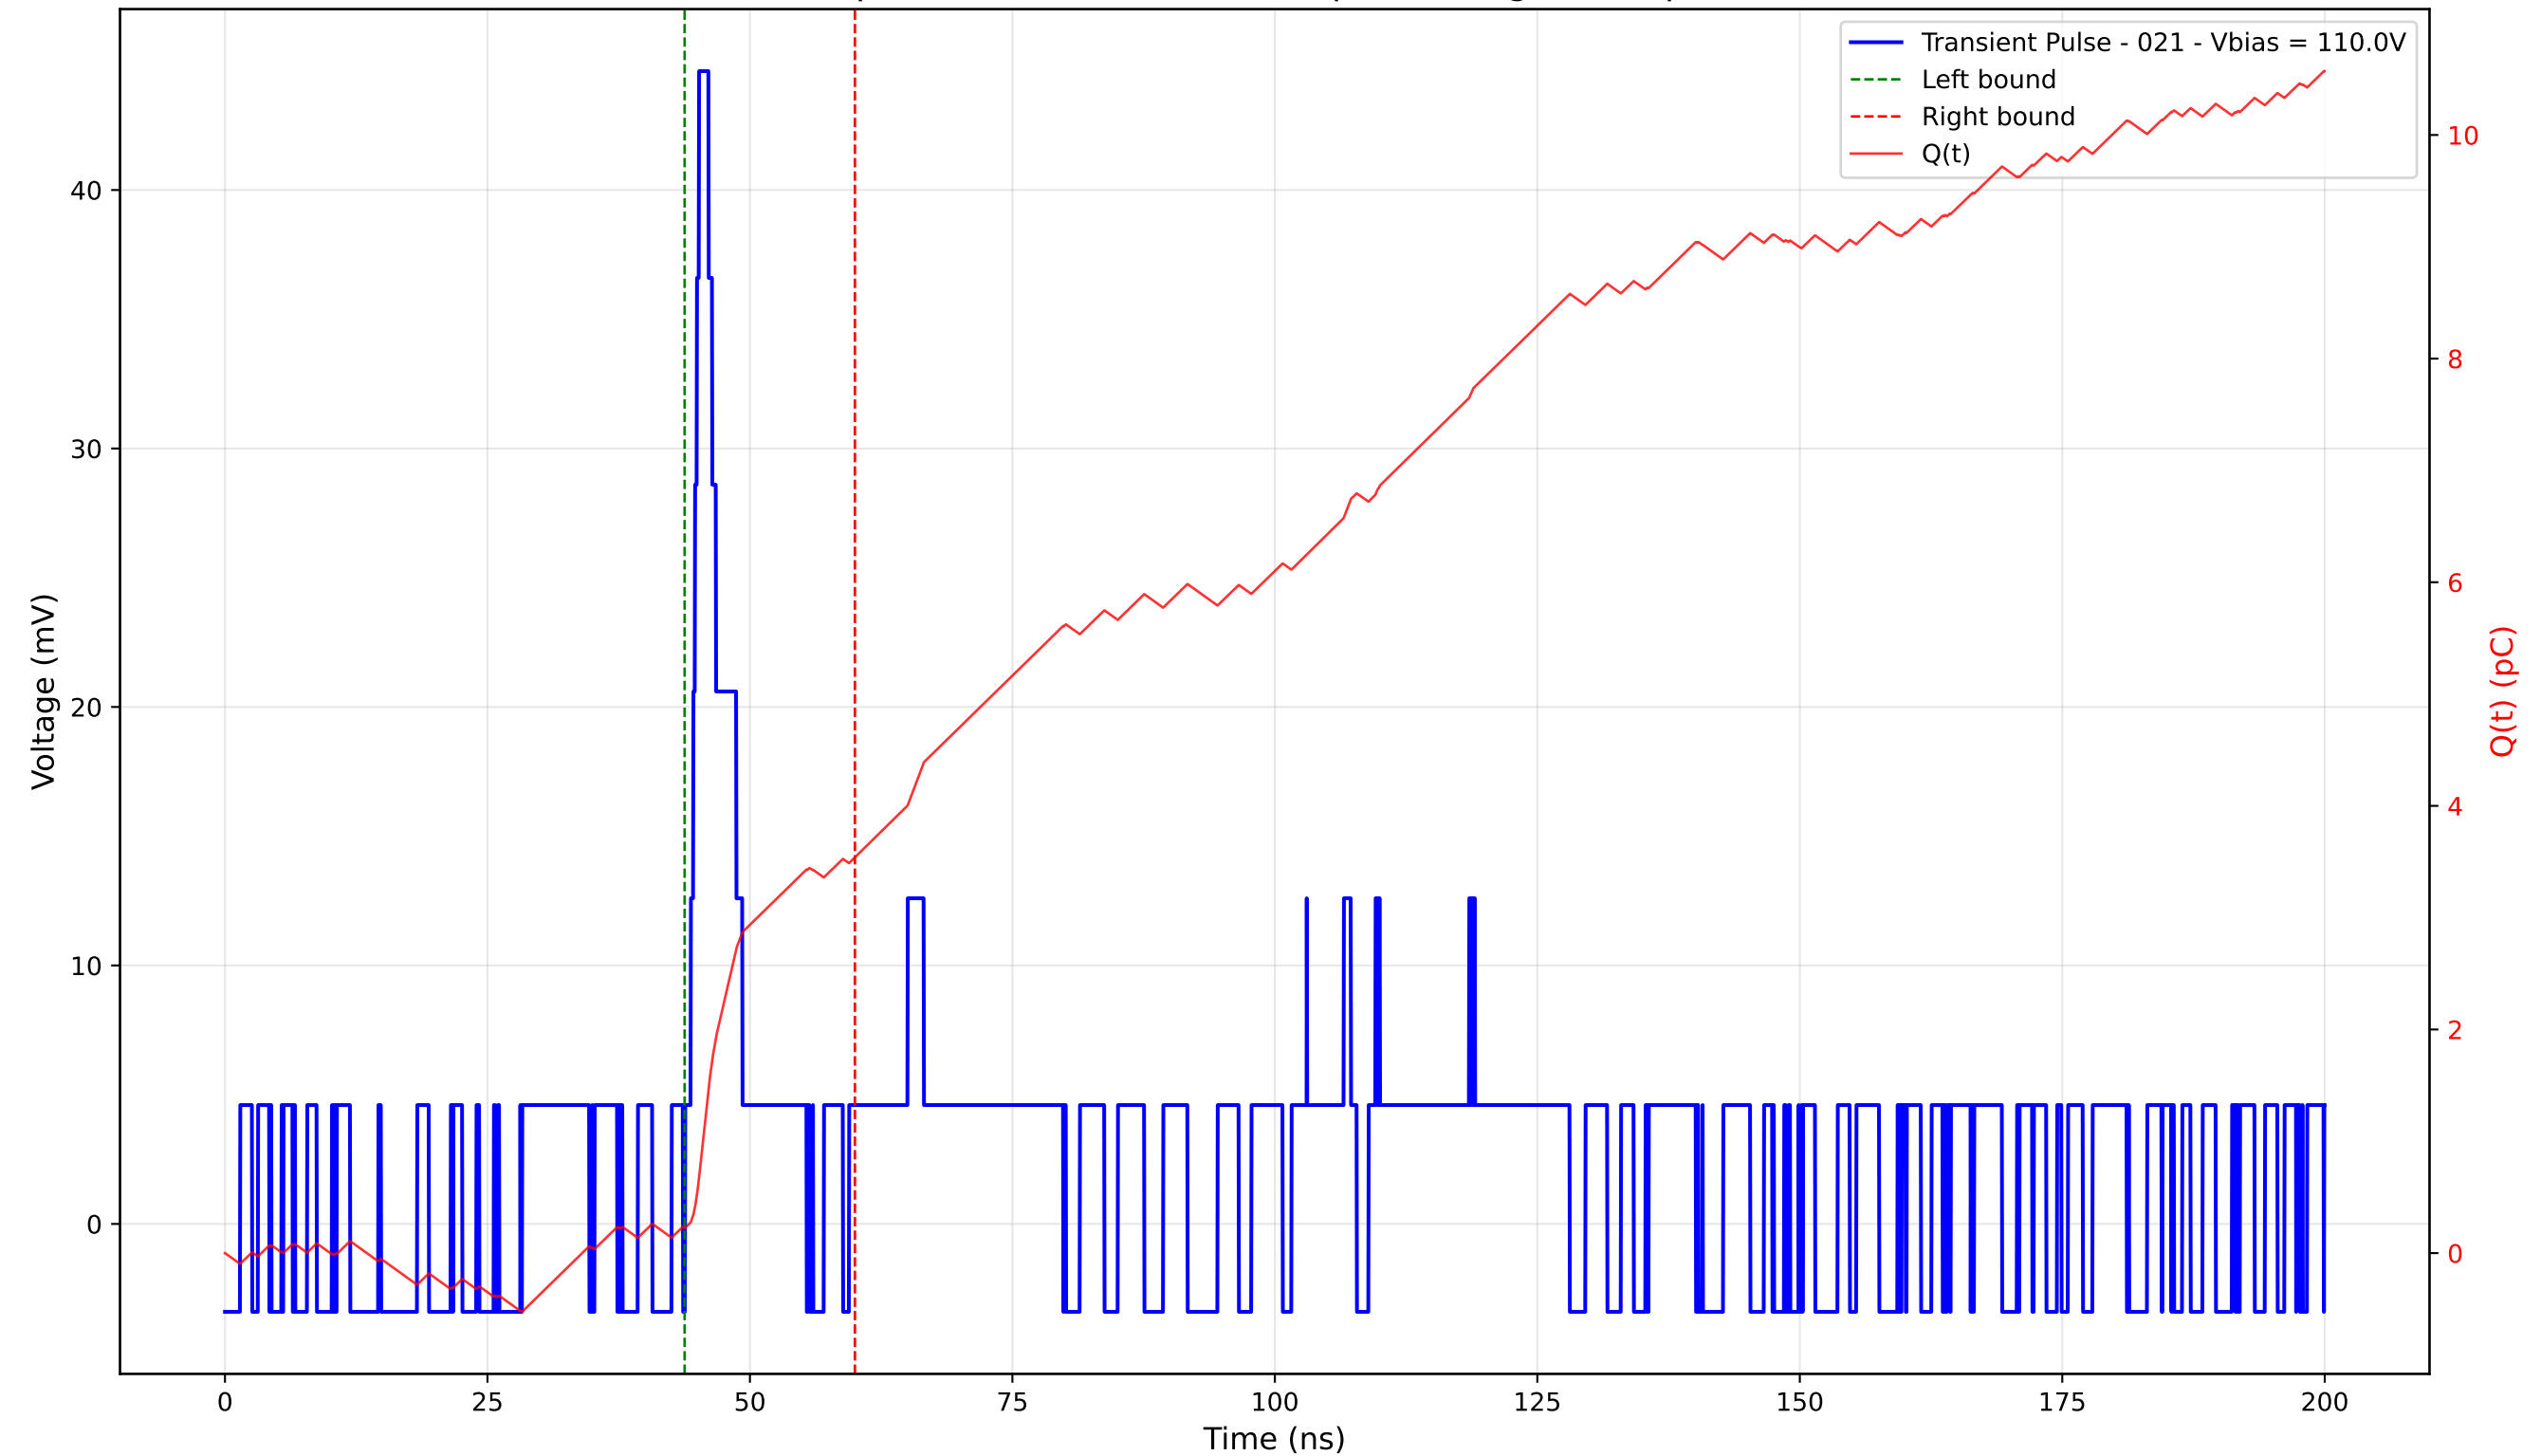


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 3.44 pC - Rise Time: 0.80 ns

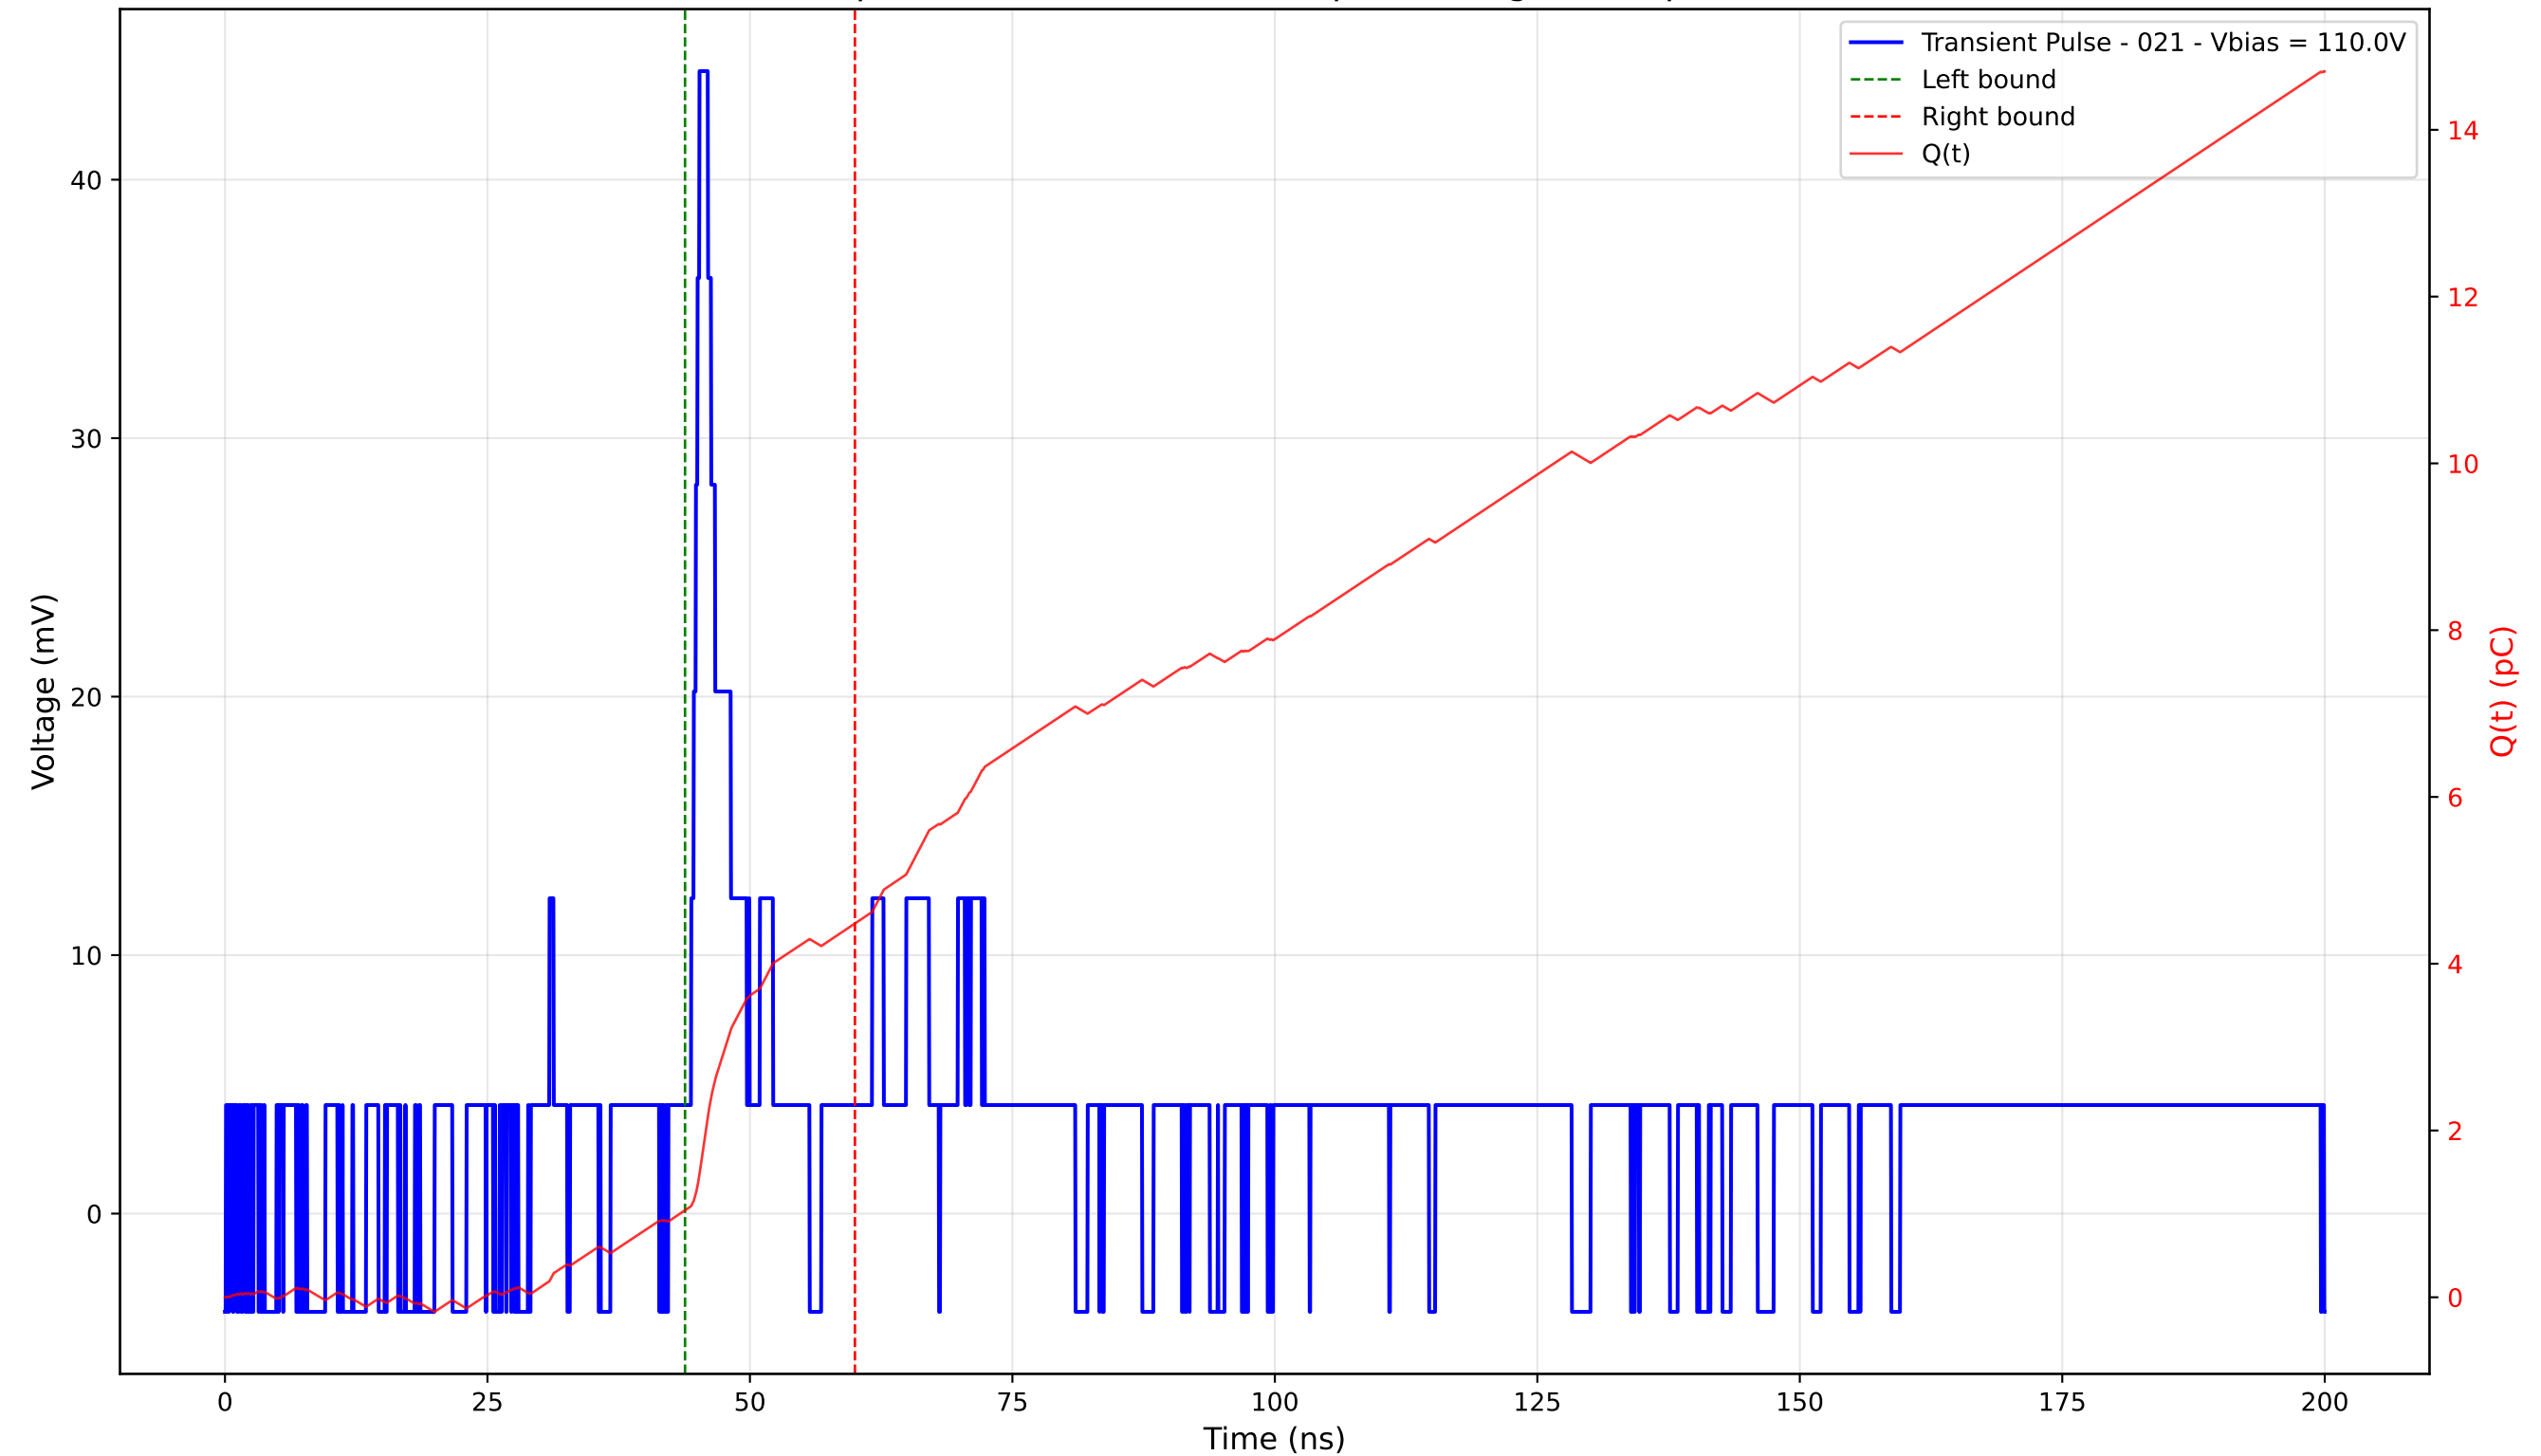


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 3.03 pC - Rise Time: 1.02 ns

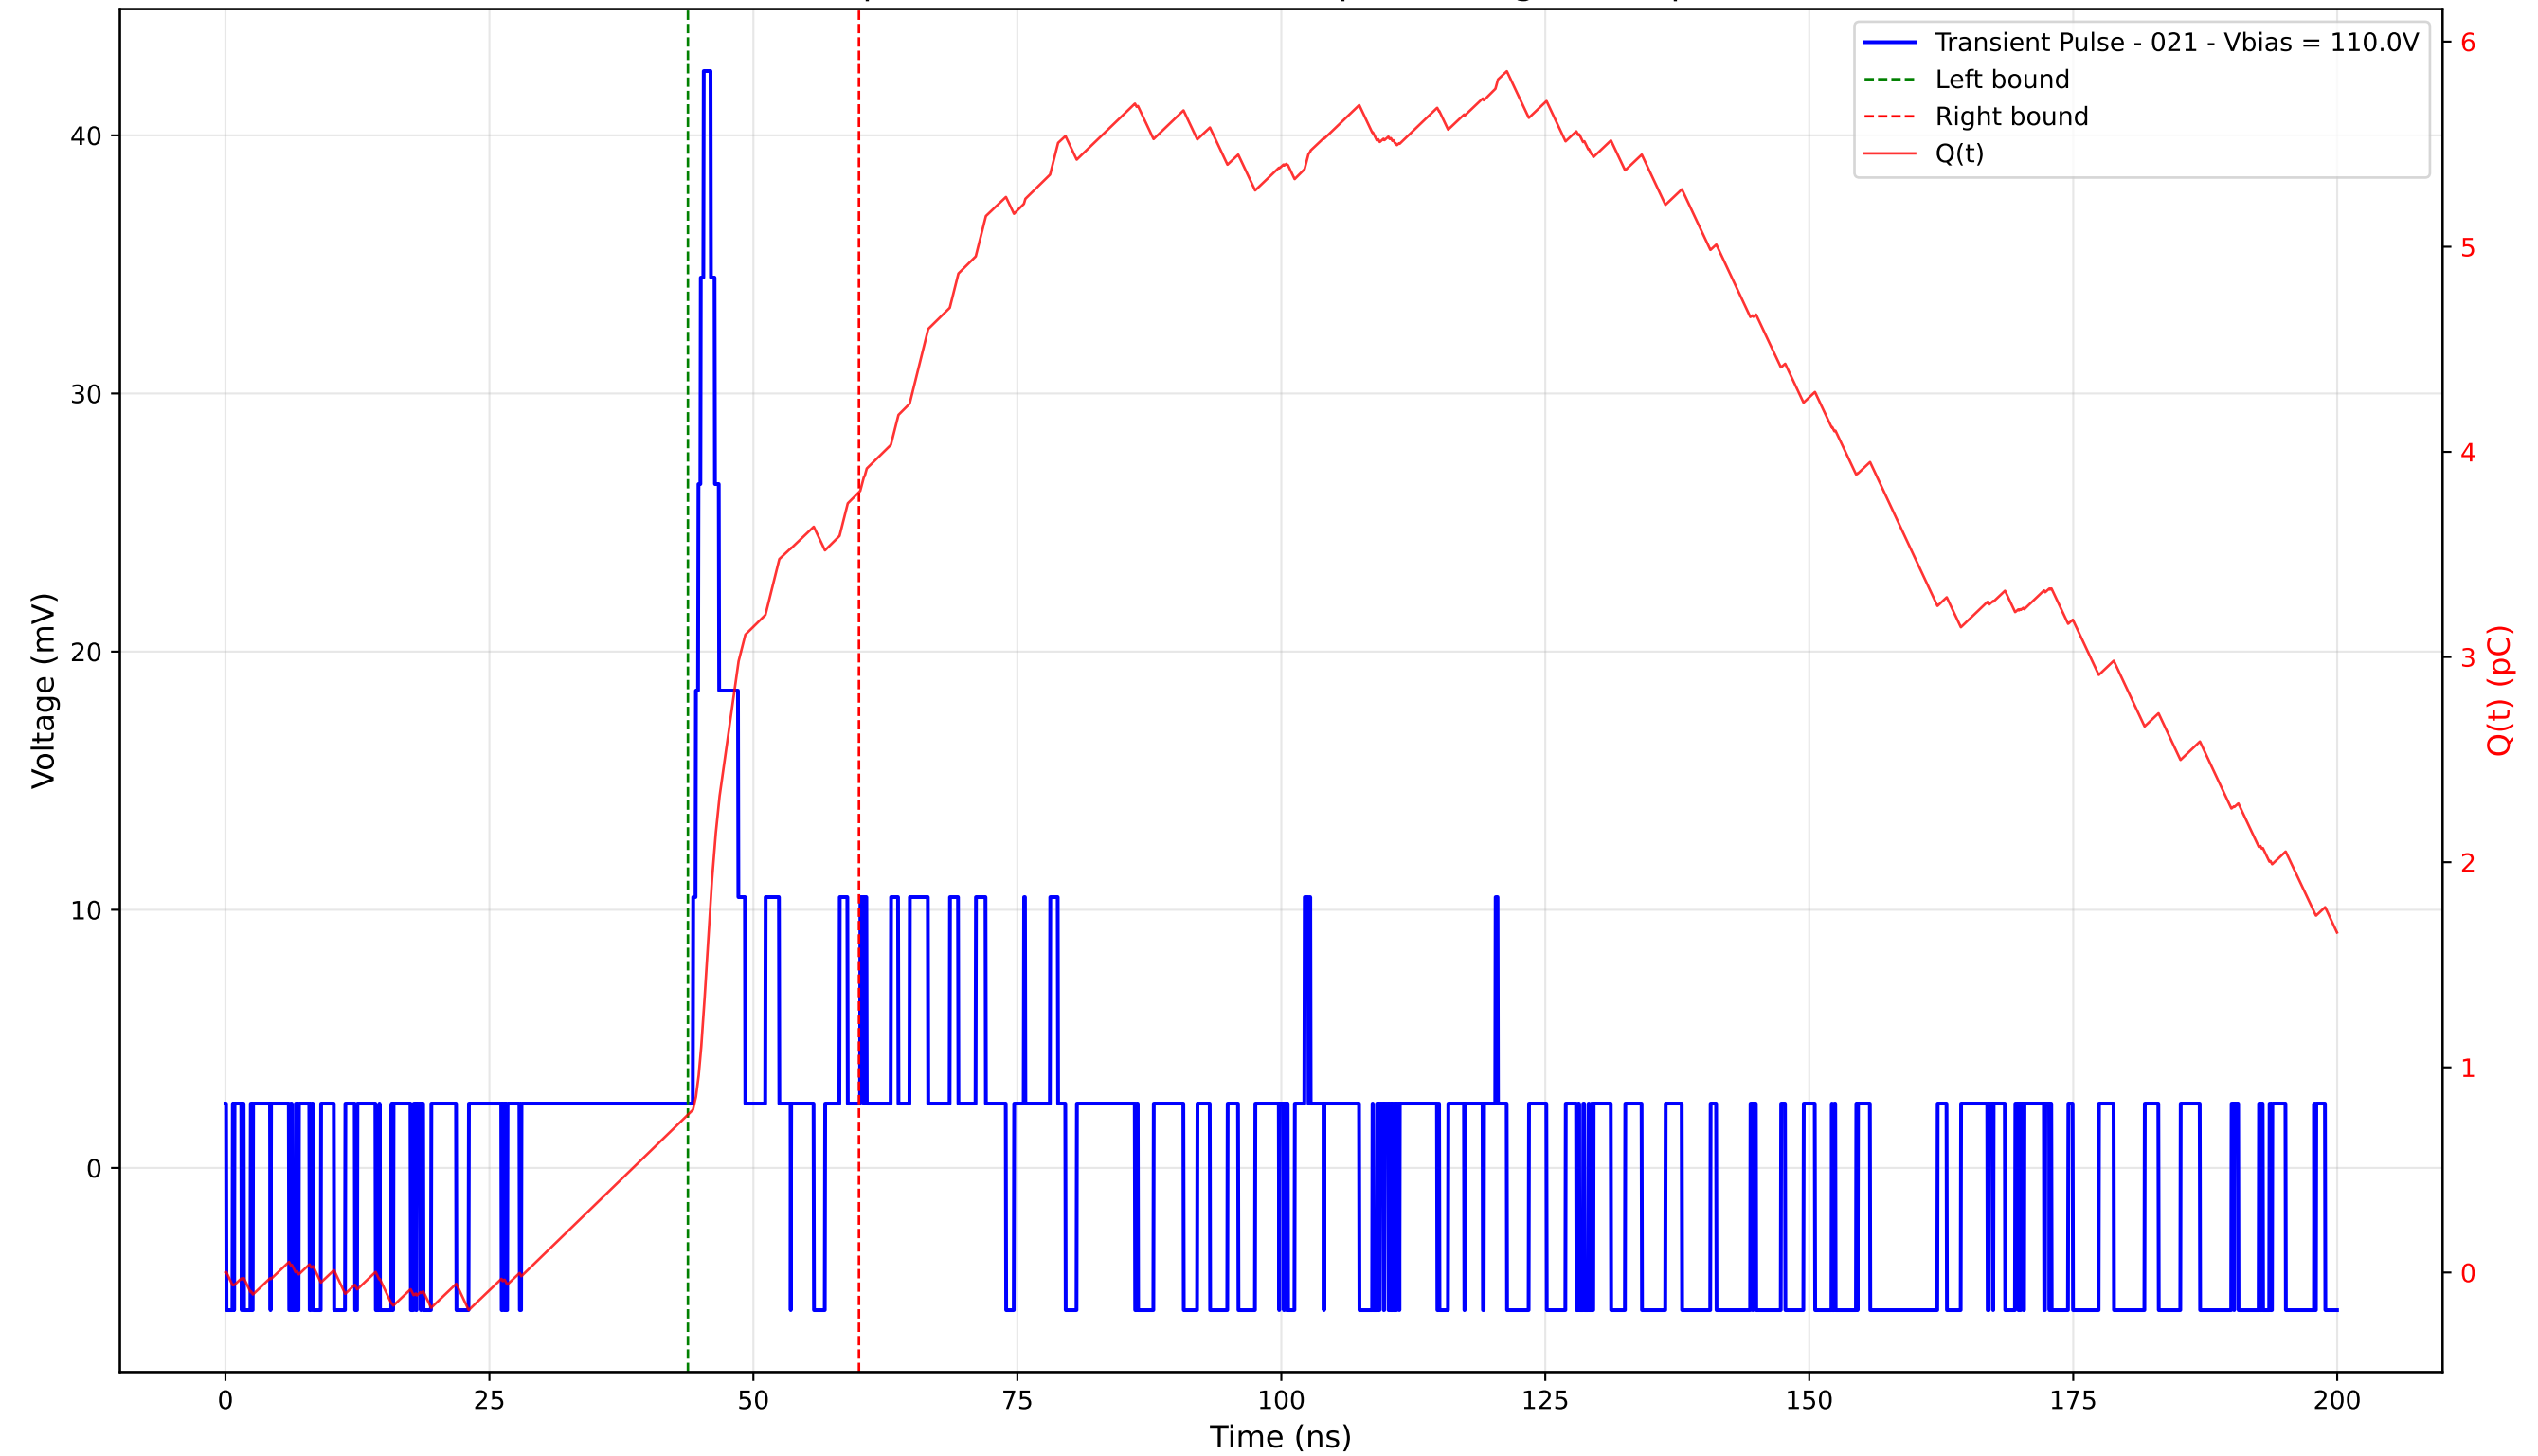


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 2.99 pC - Rise Time: 1.10 ns

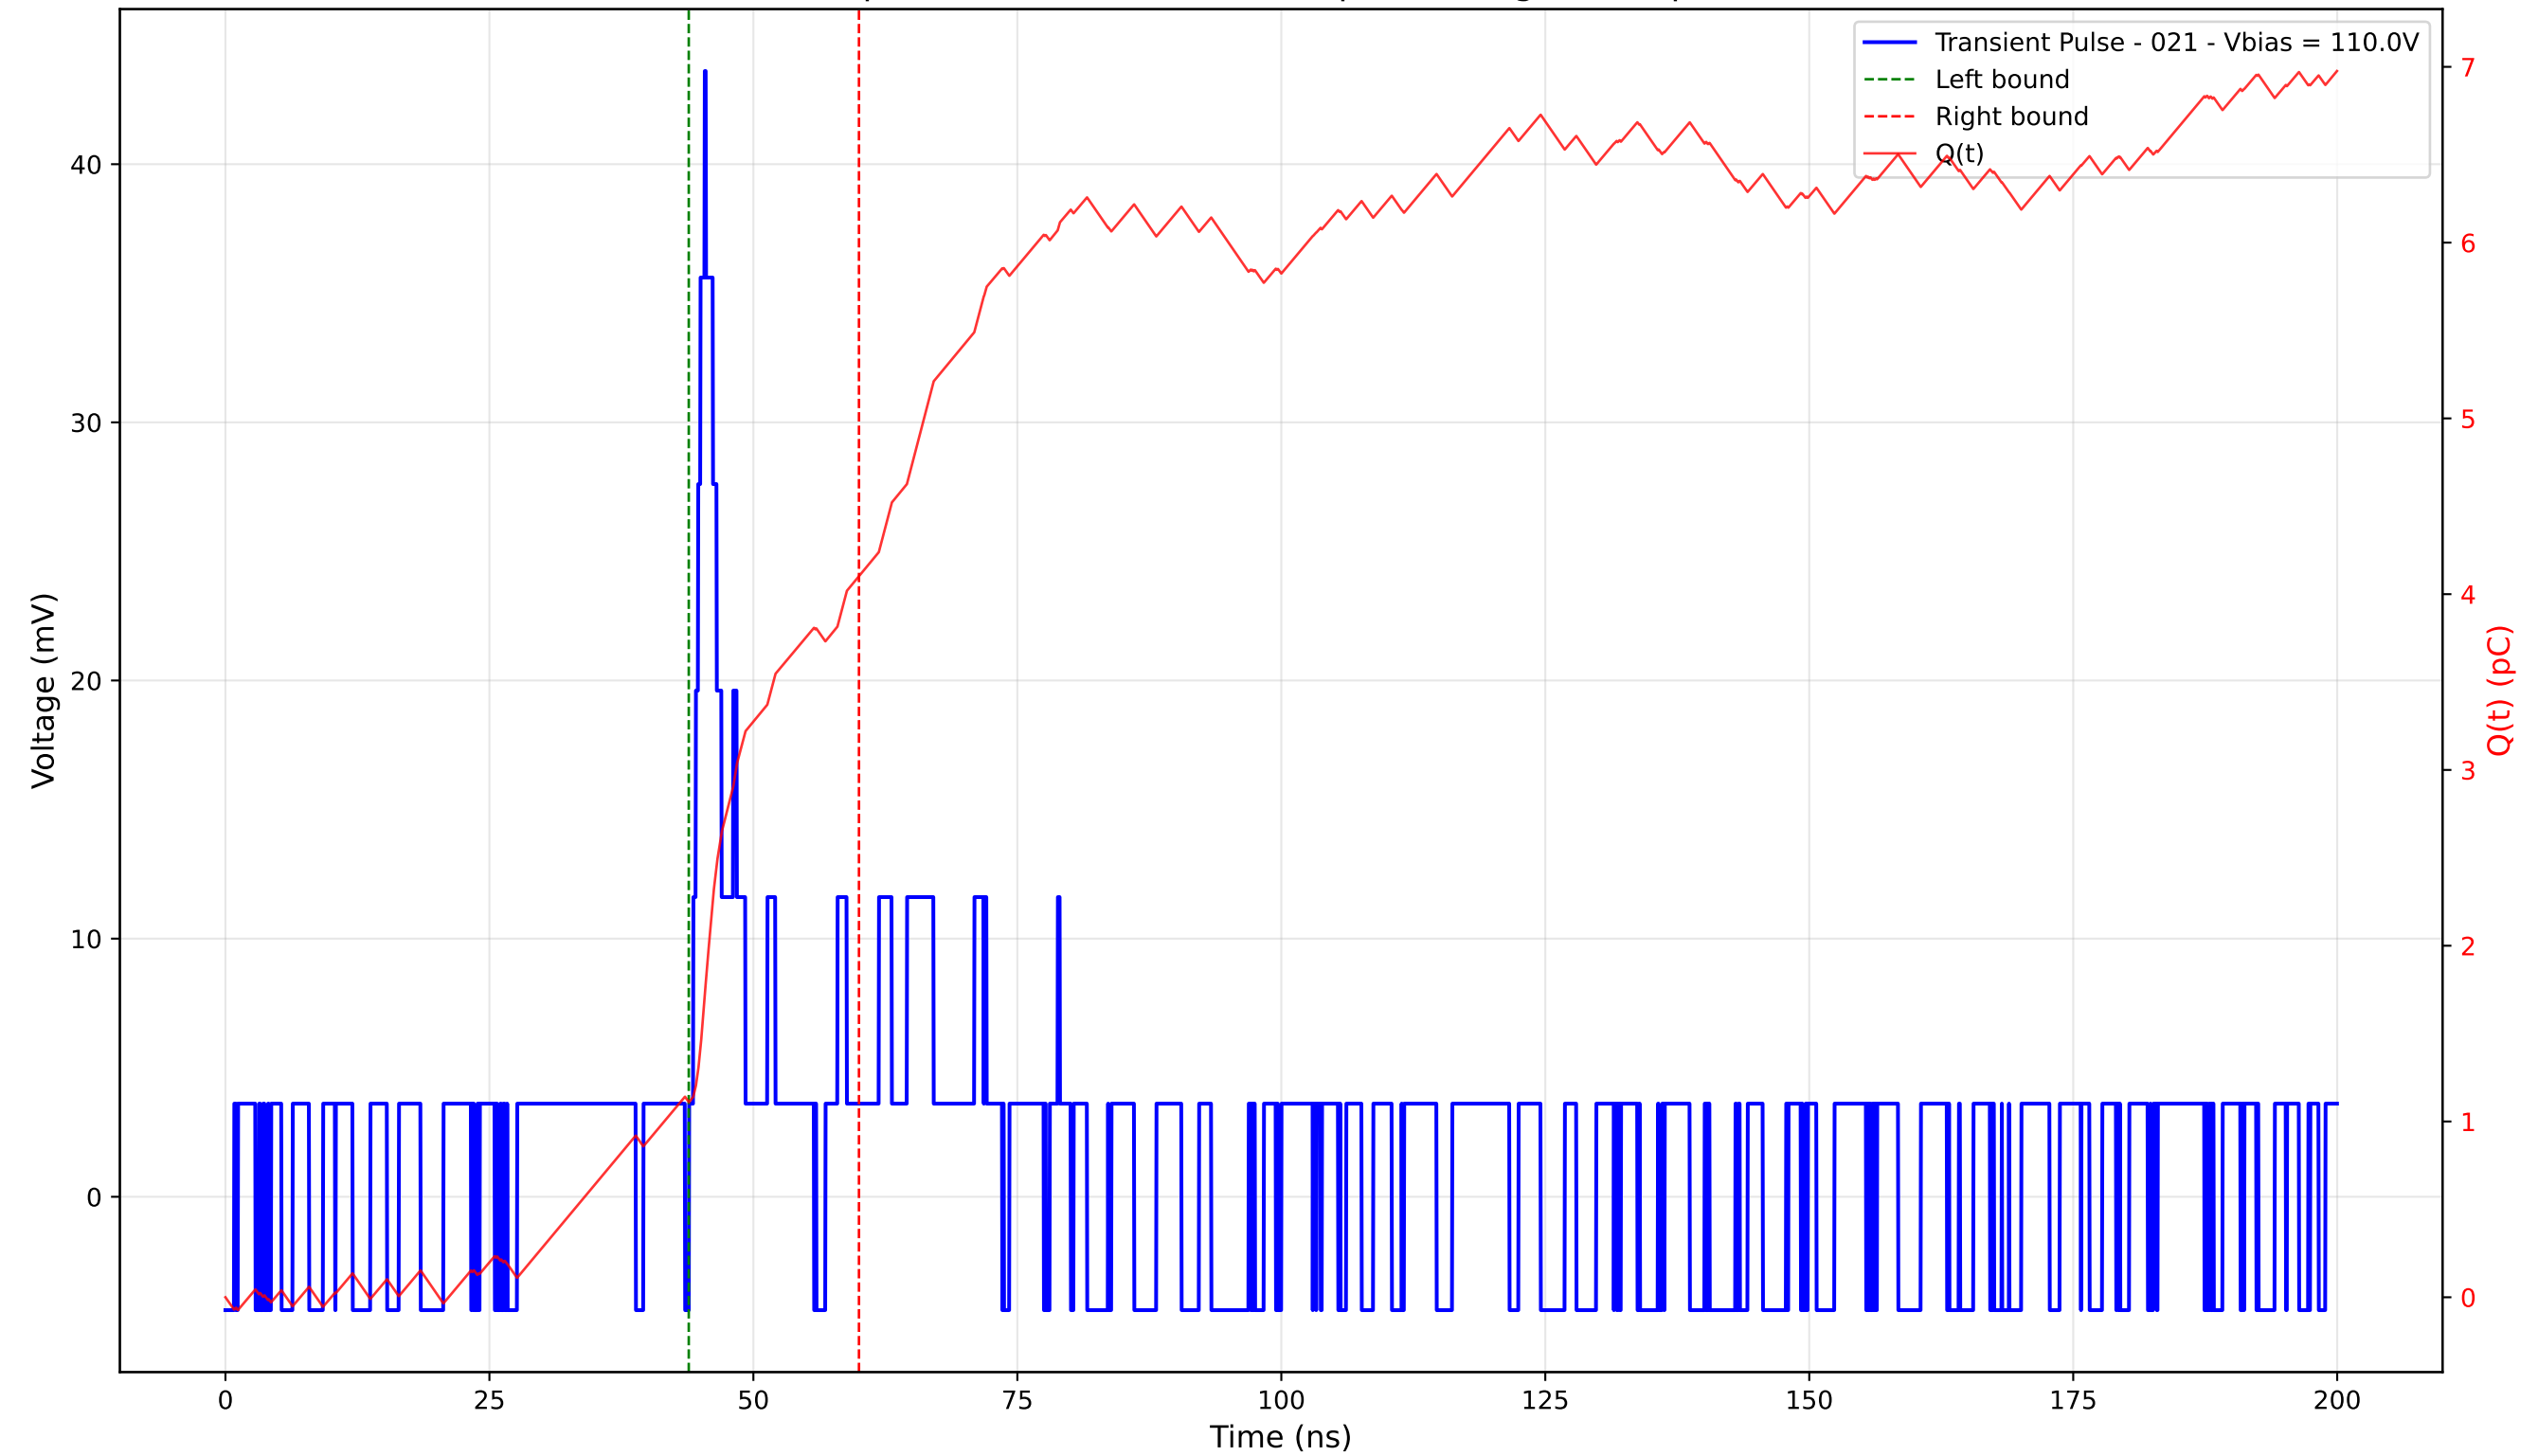


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 2.88 pC - Rise Time: 2.70 ns

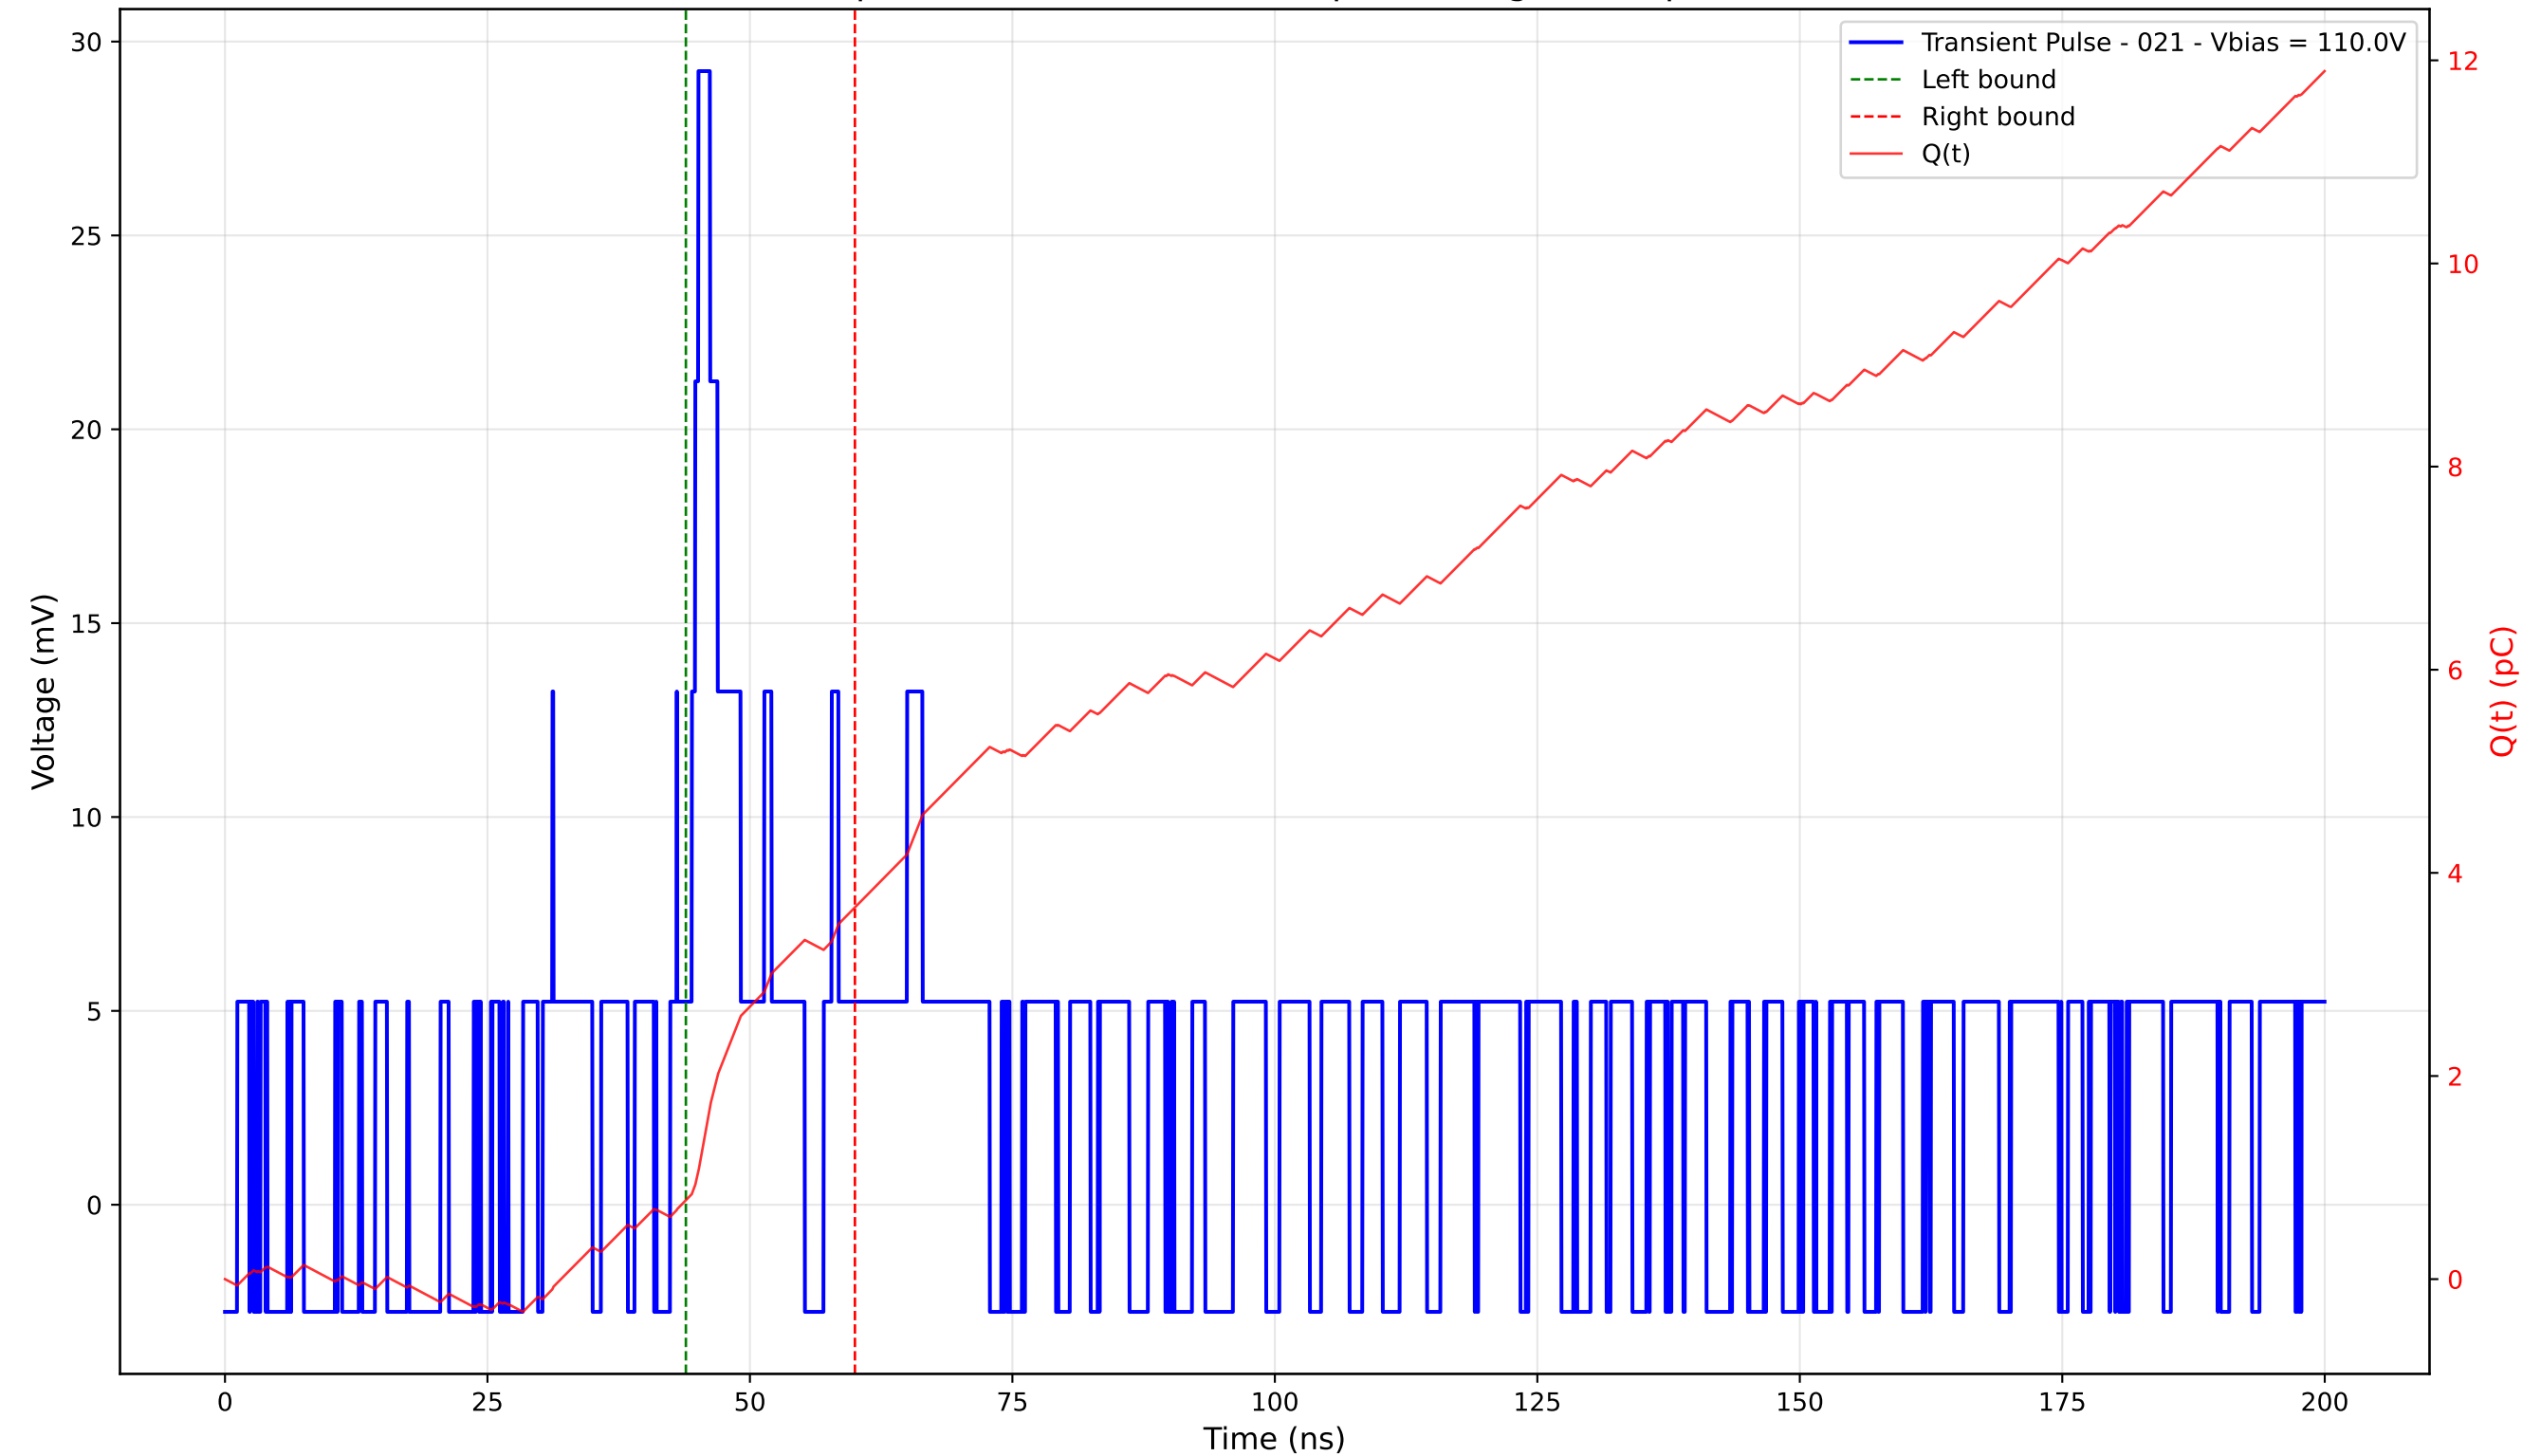

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 2.46 pC - Rise Time: 0.98 ns

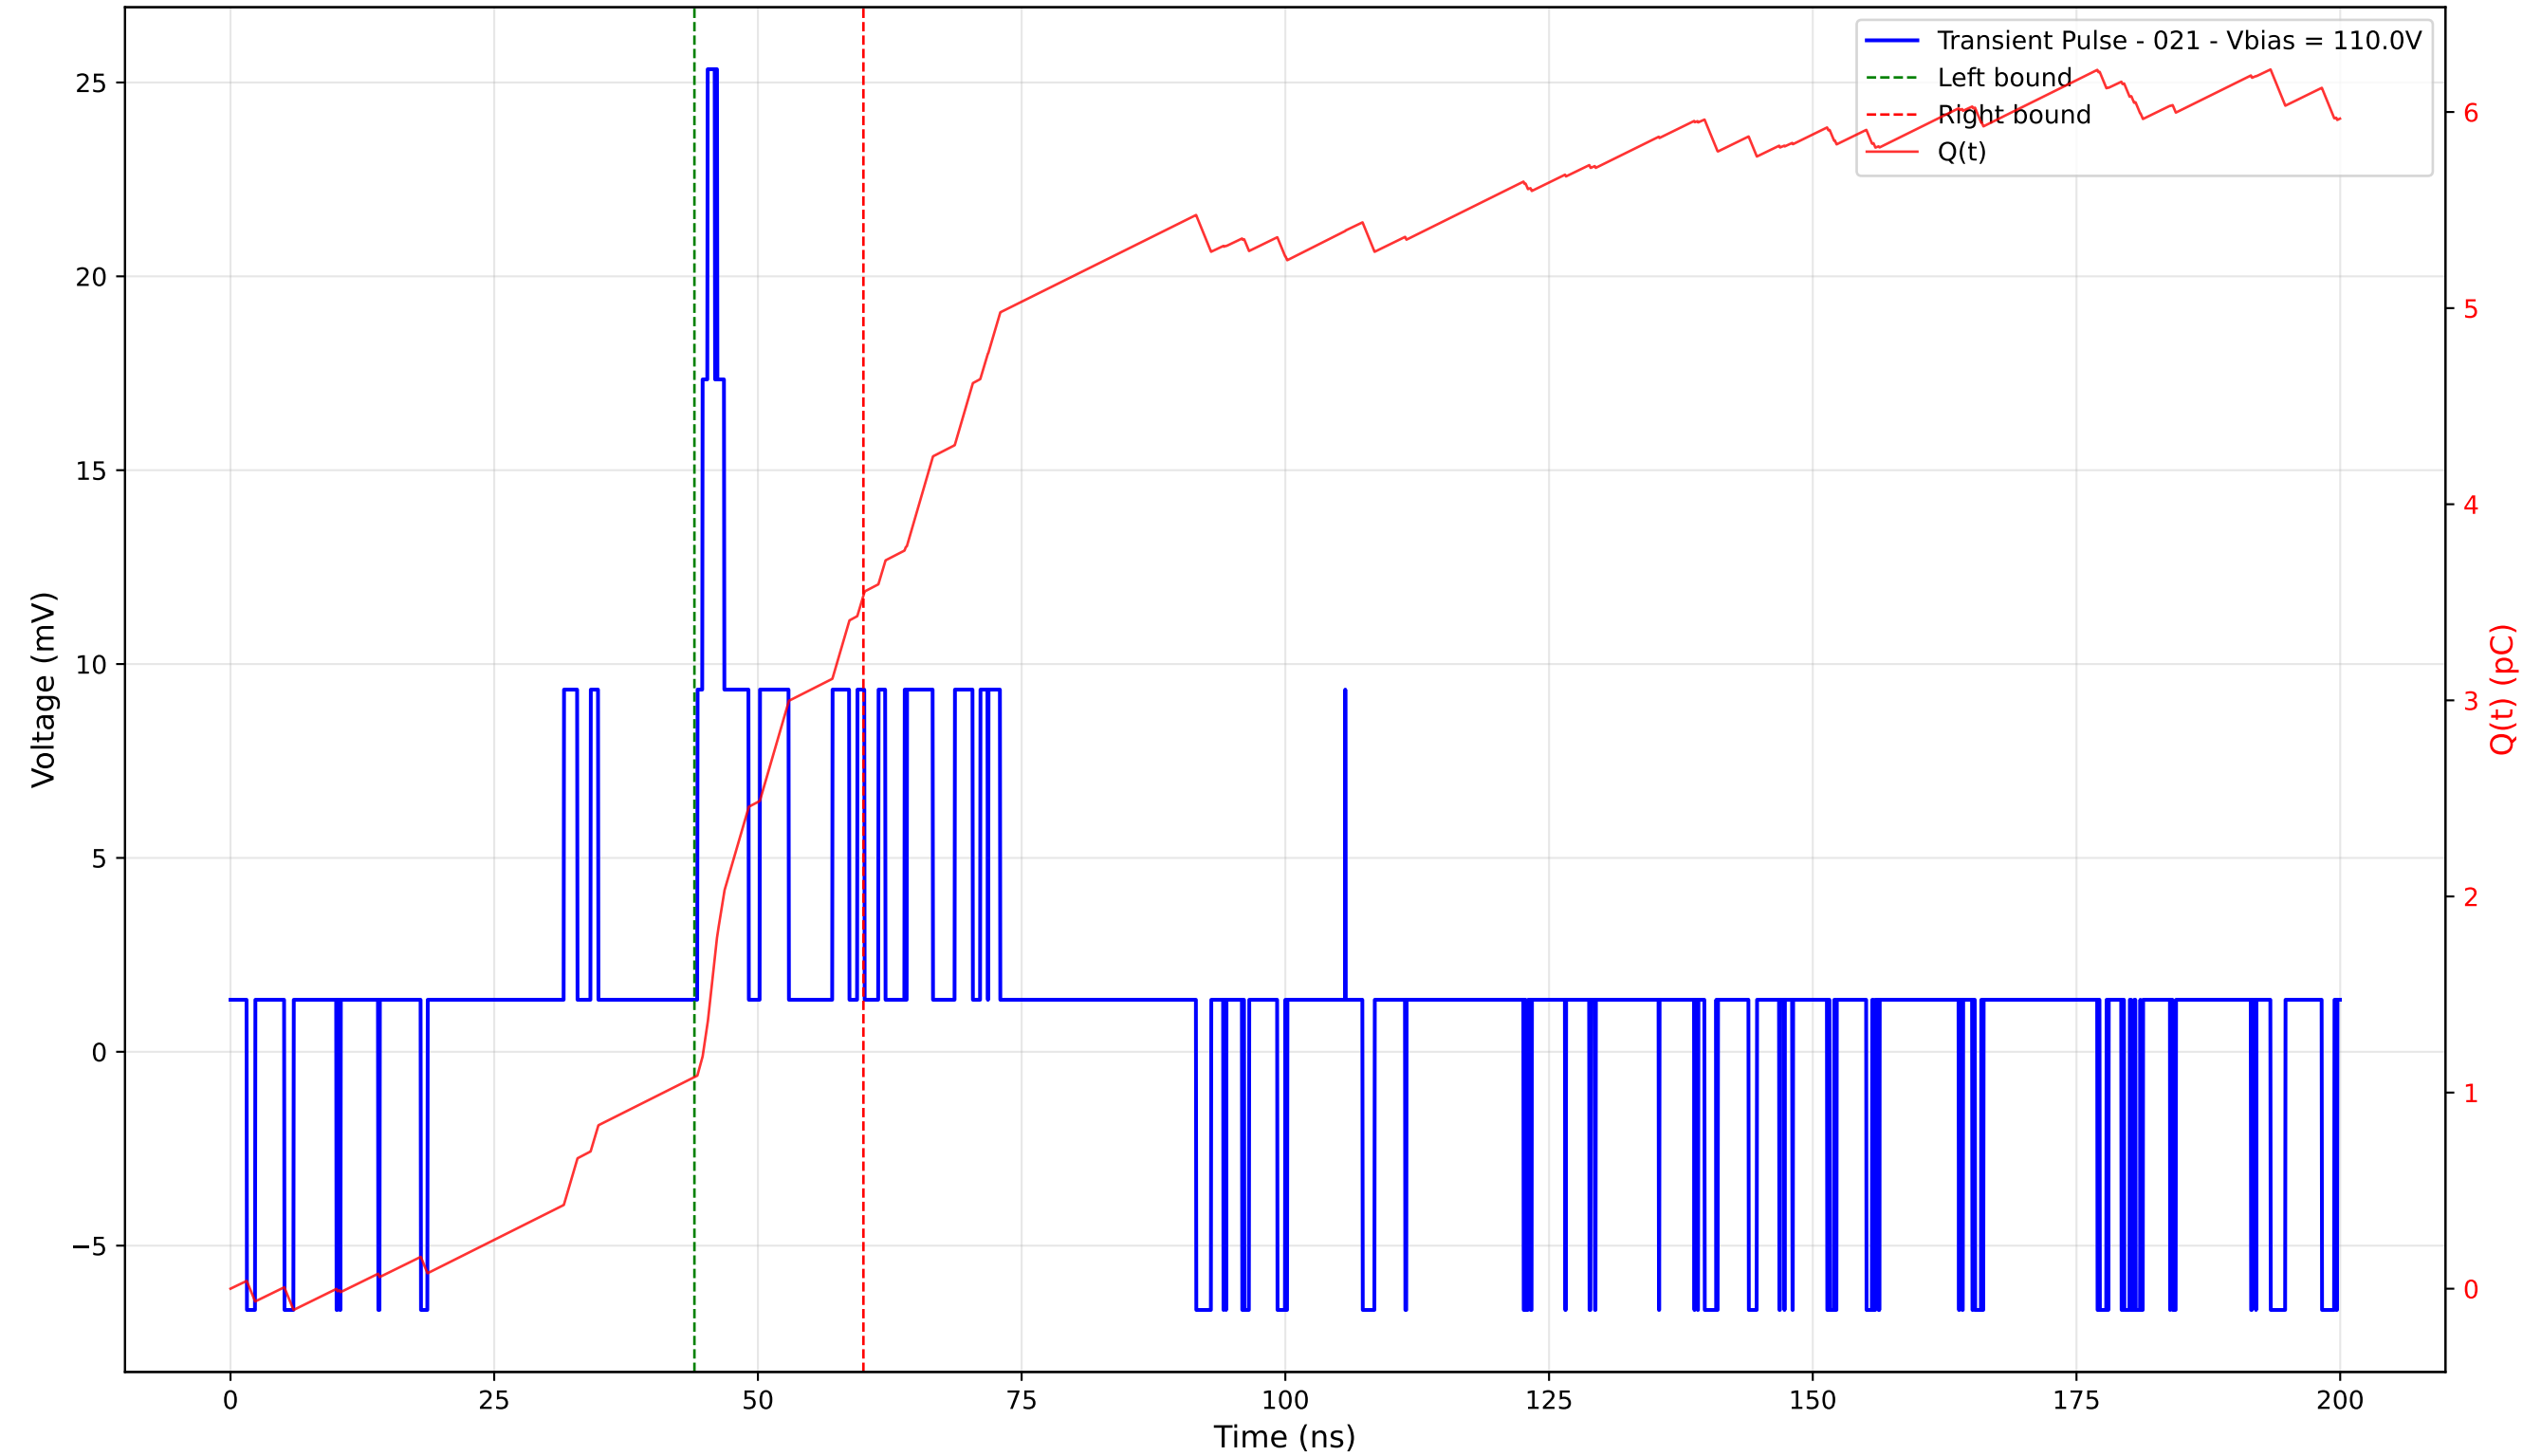

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 3.81 pC - Rise Time: 8.22 ns

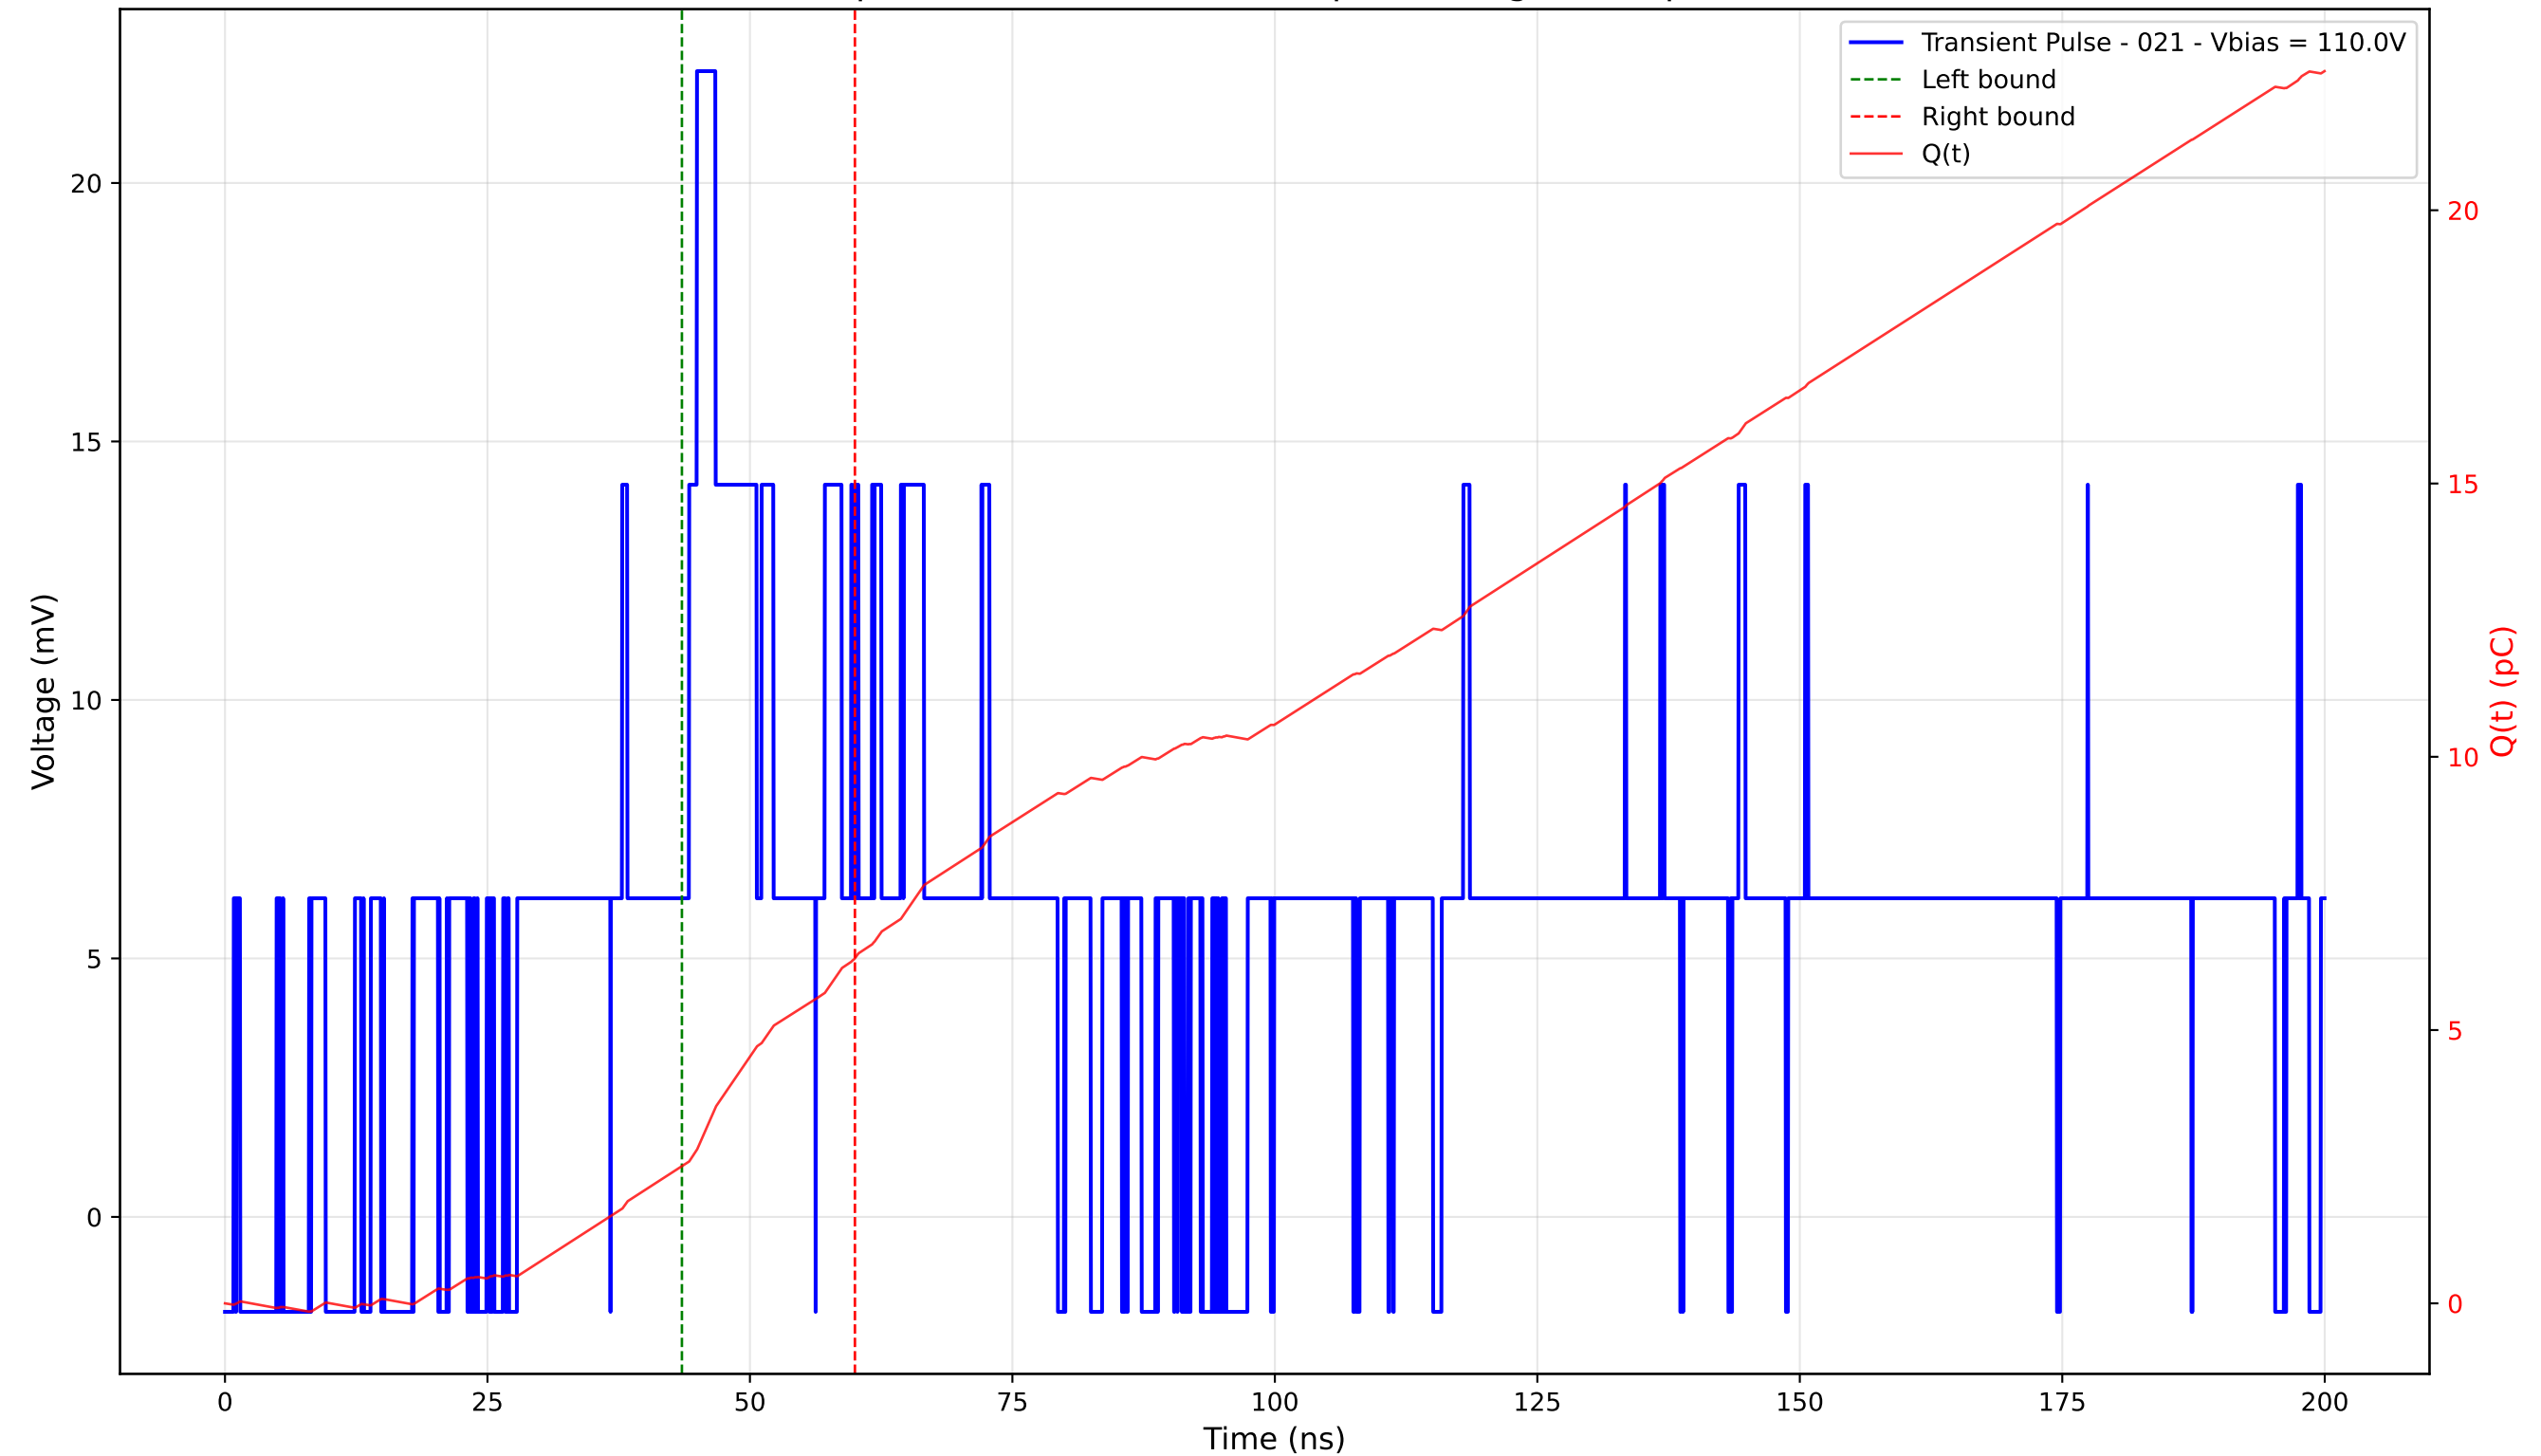

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 2.66 pC - Rise Time: 0.00 ns (N/A)

