


TCT Run 024 Summary

Parameter	Value
Run	Run024
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	60.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\60V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

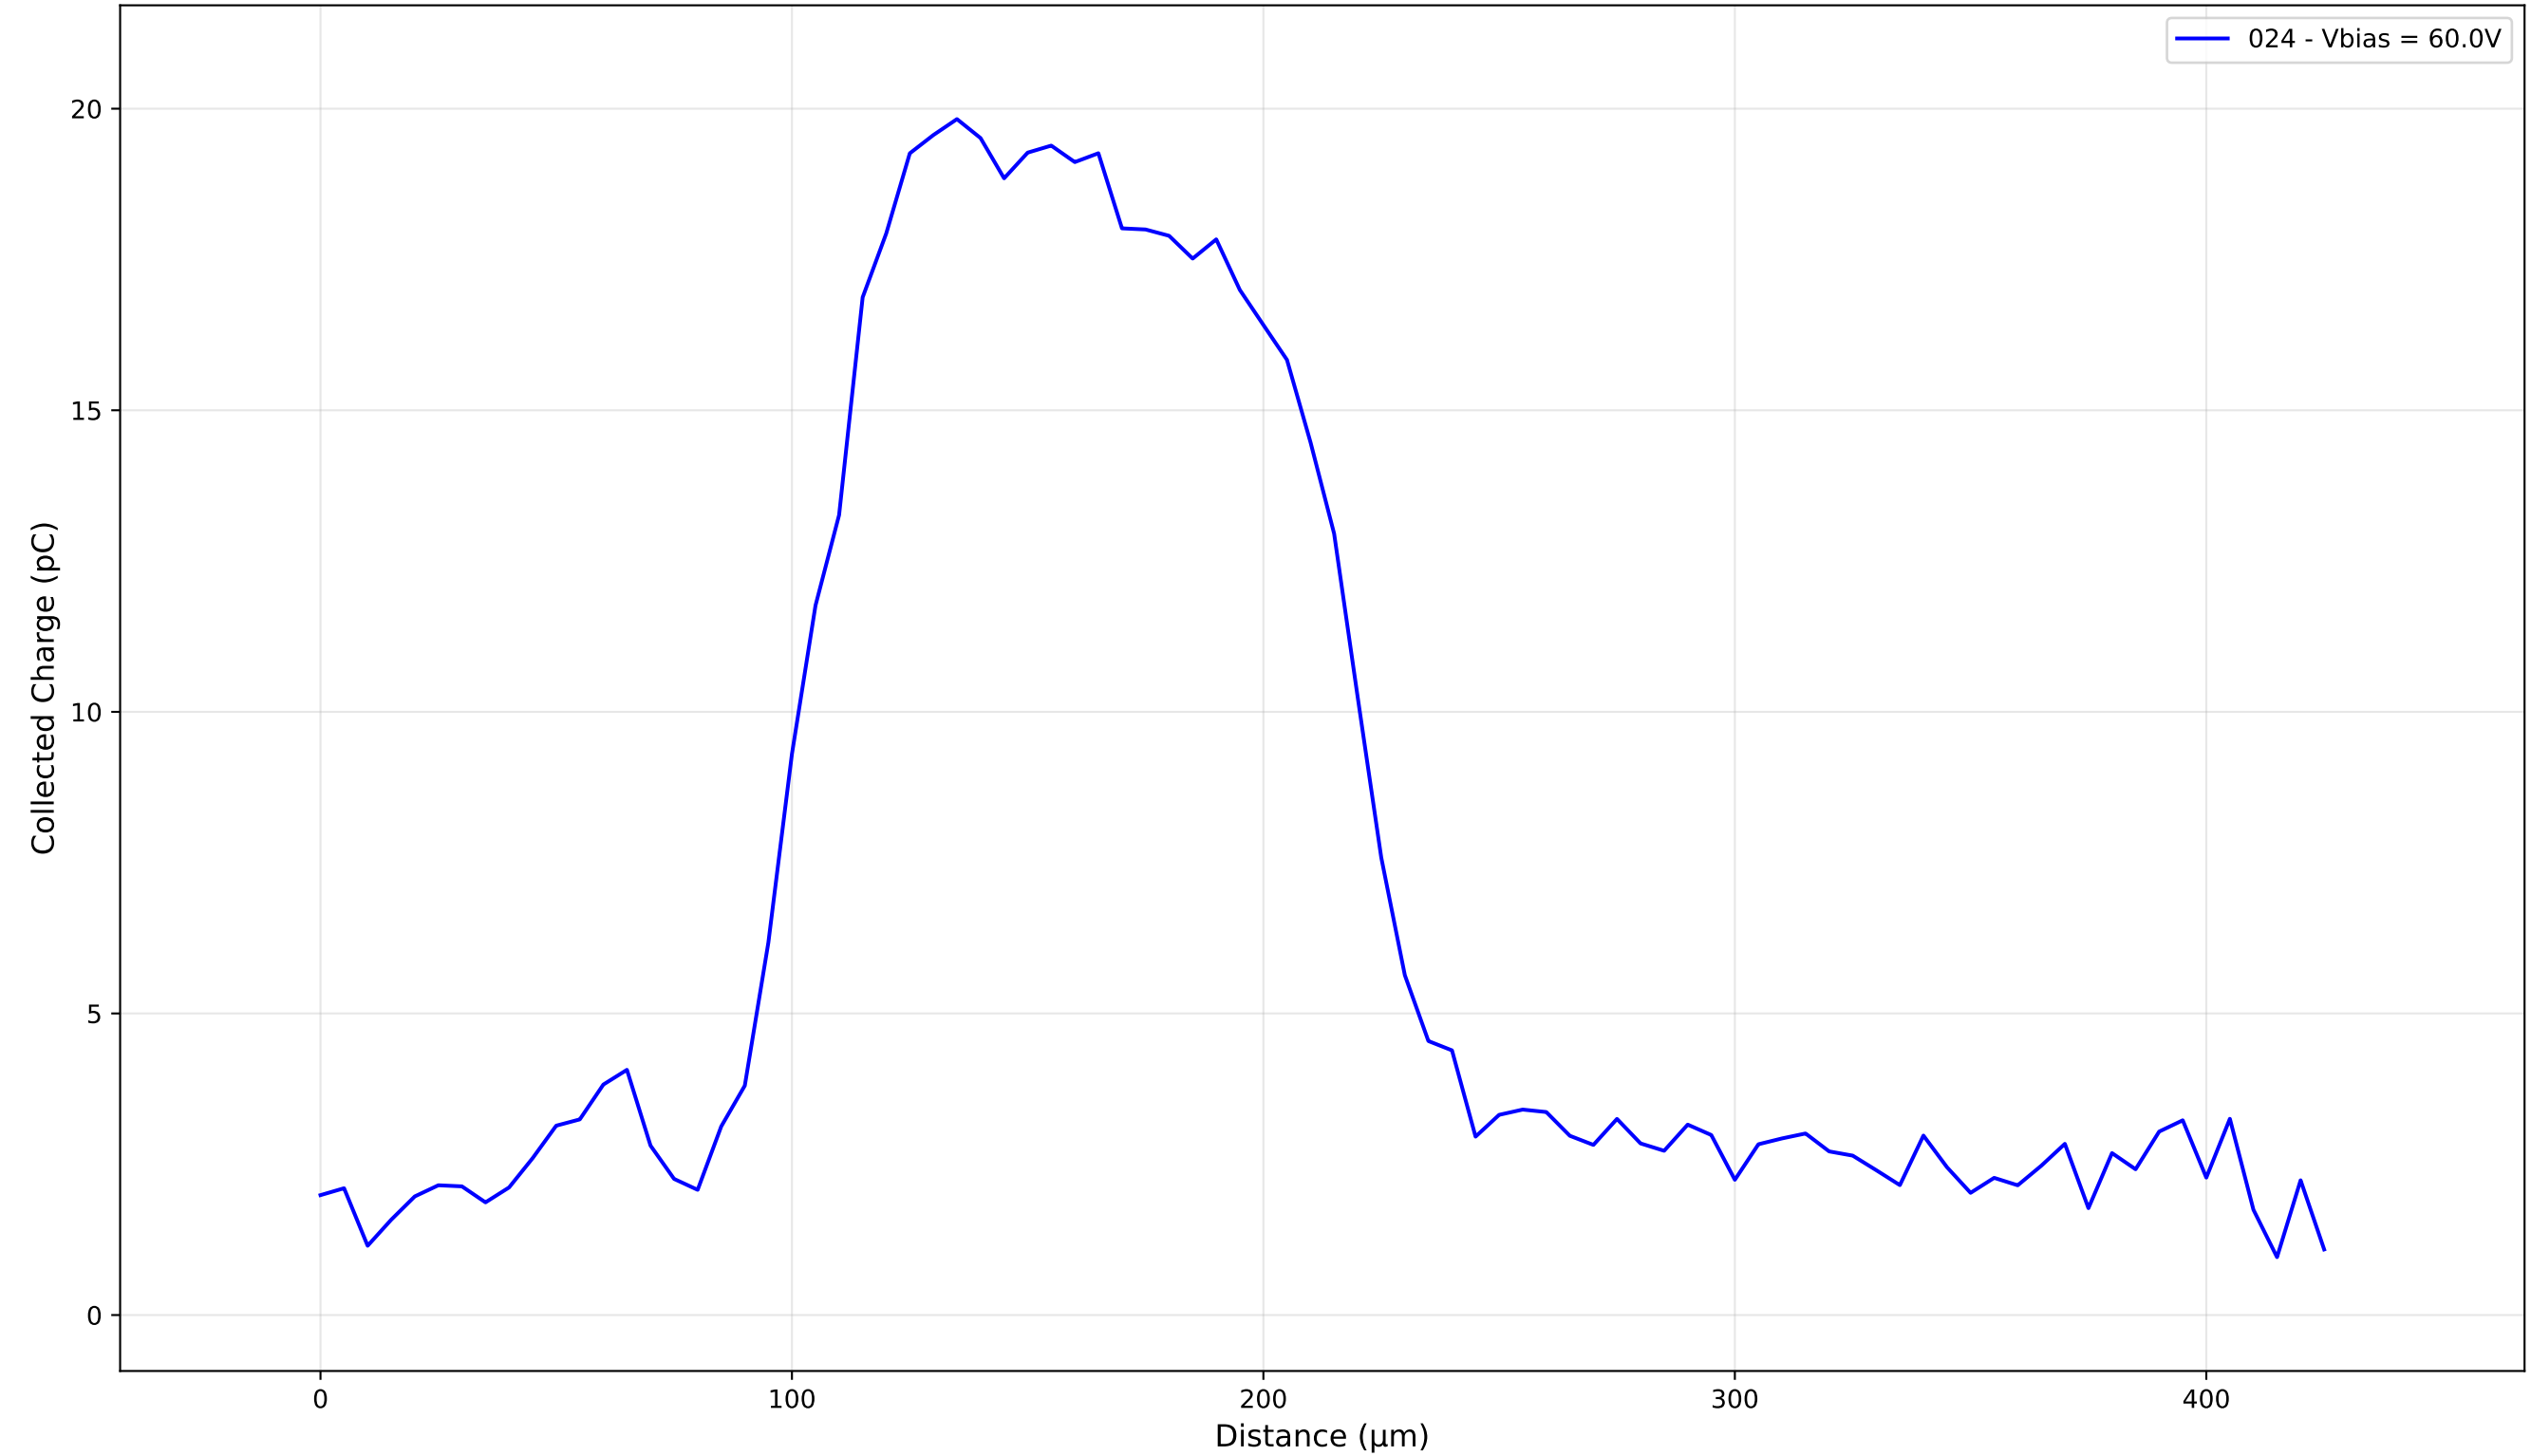

Collected Charge

024 - Vbias = 60.0V

Collected Charge [a.u.]

1.0

0.8

0.6

0.4

0.2

0.0

0


100

200


300

400


Distance (μm)

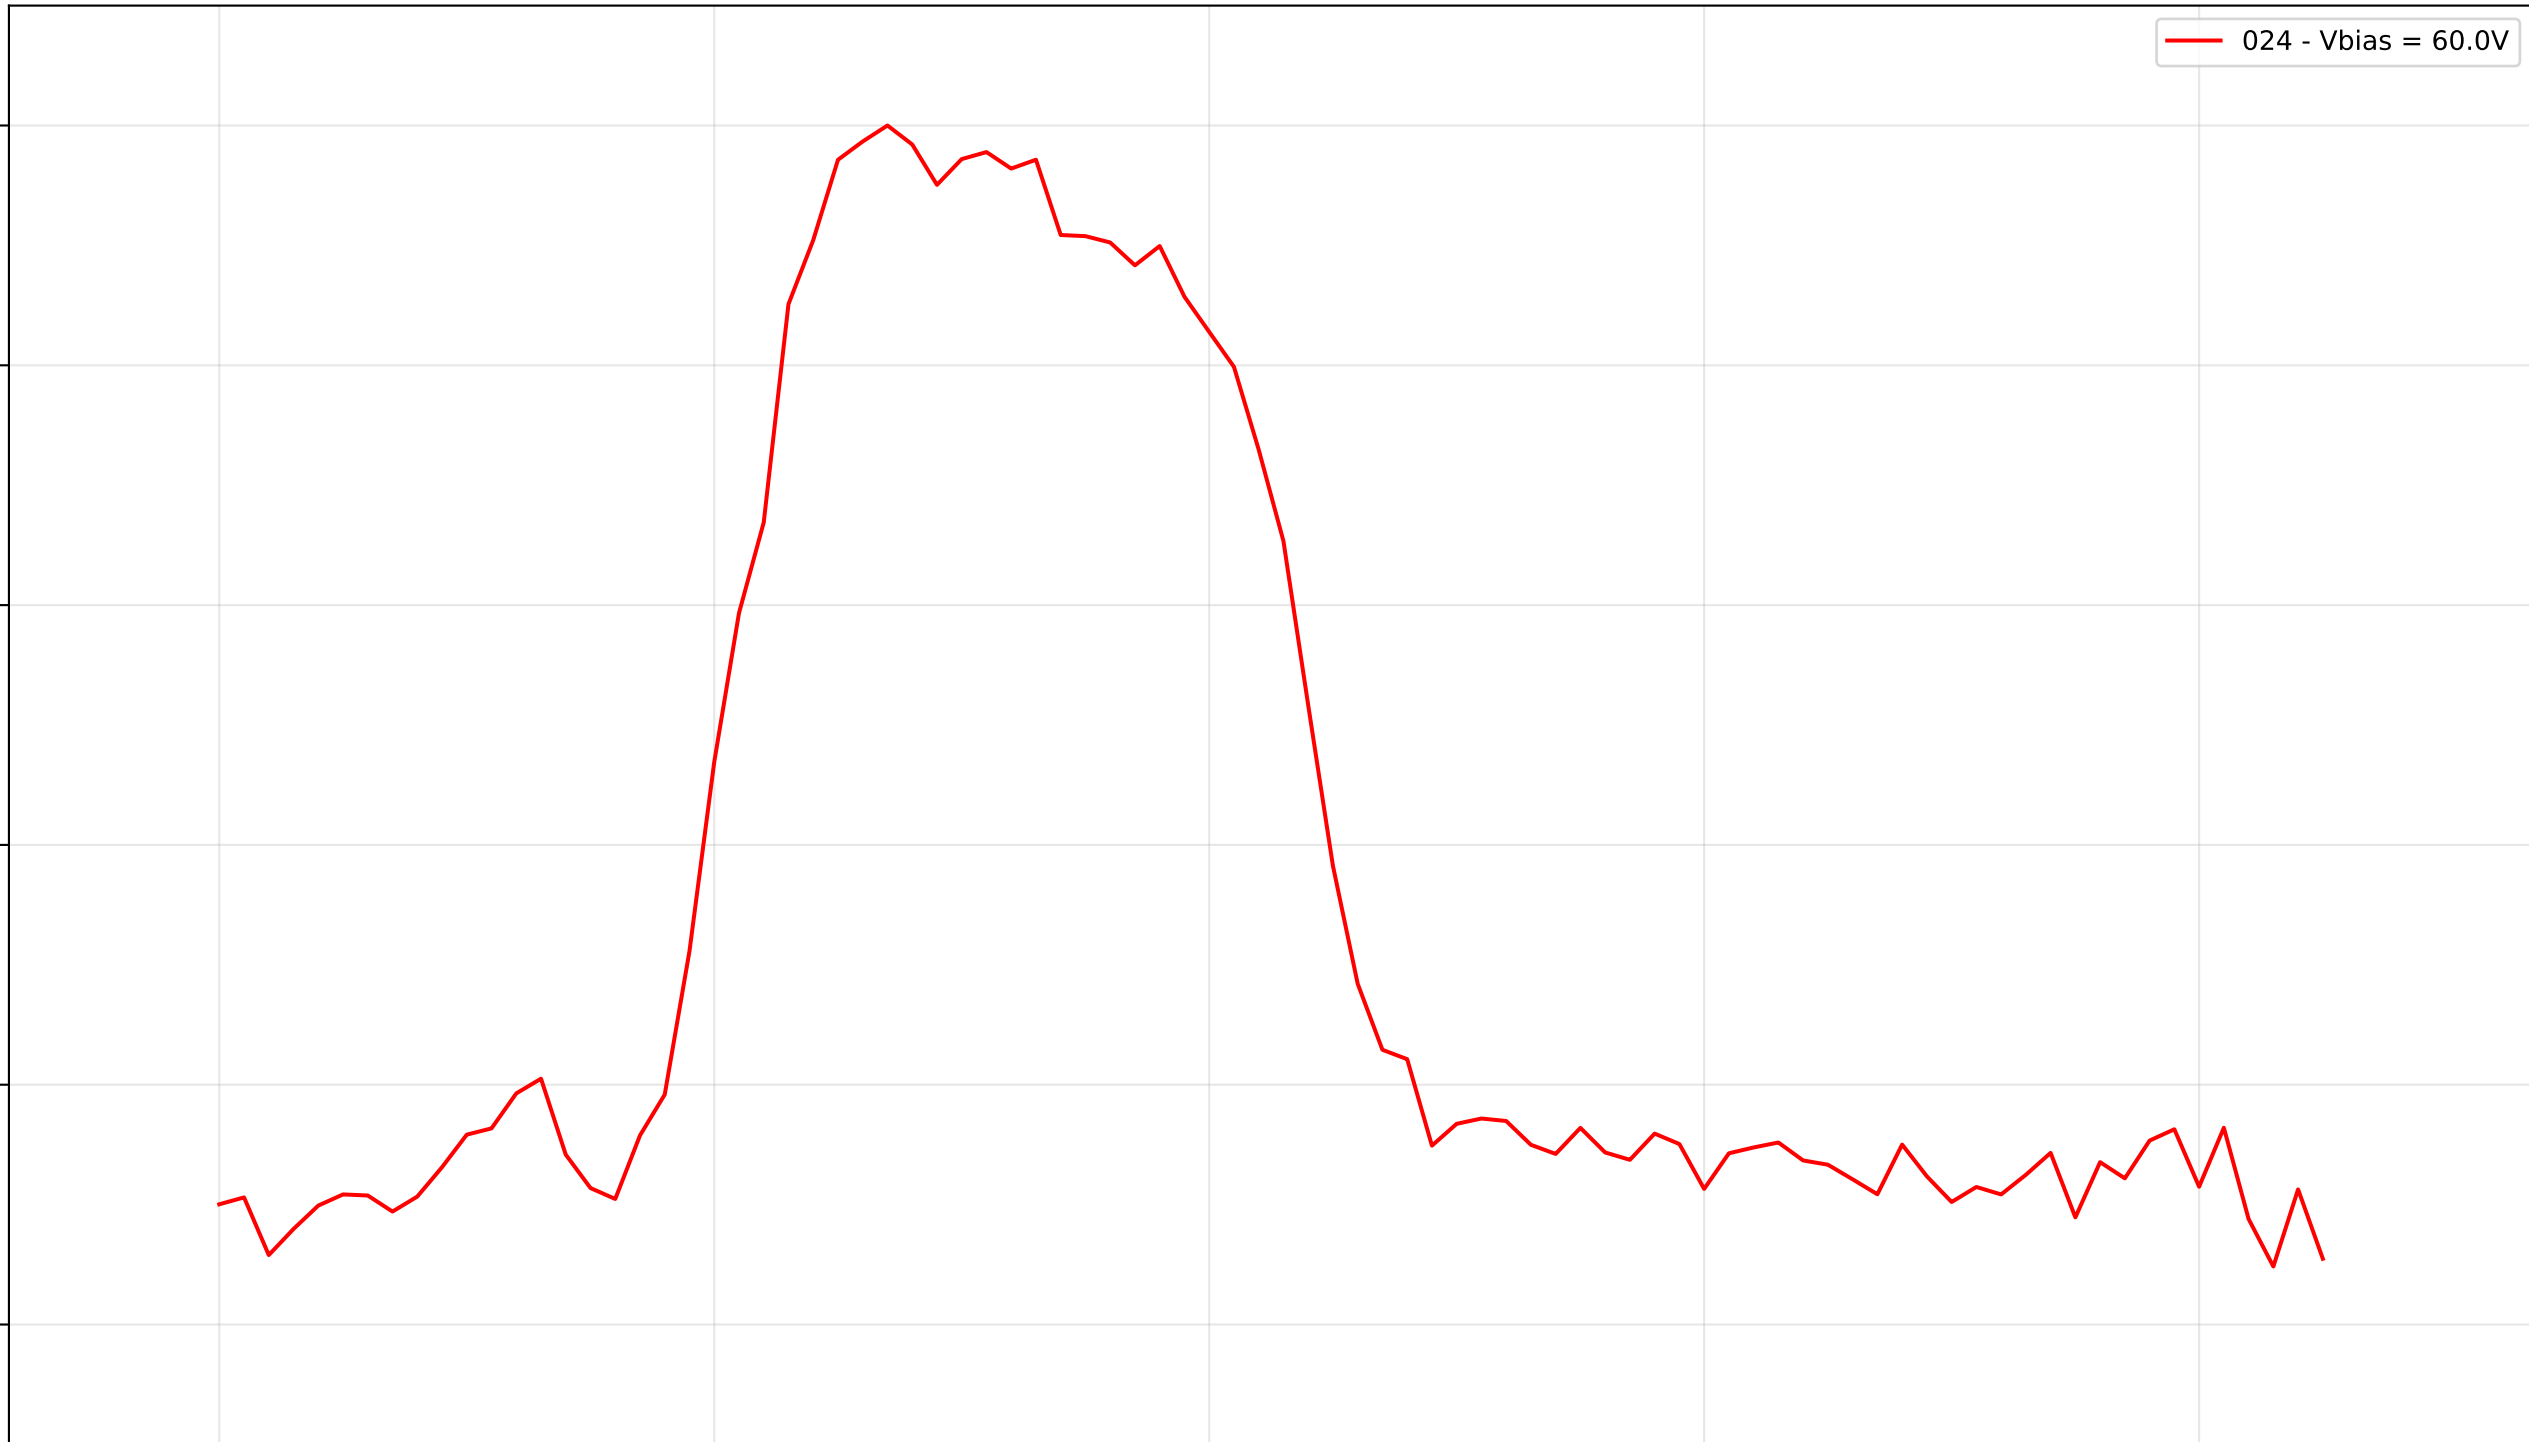


Rise Time

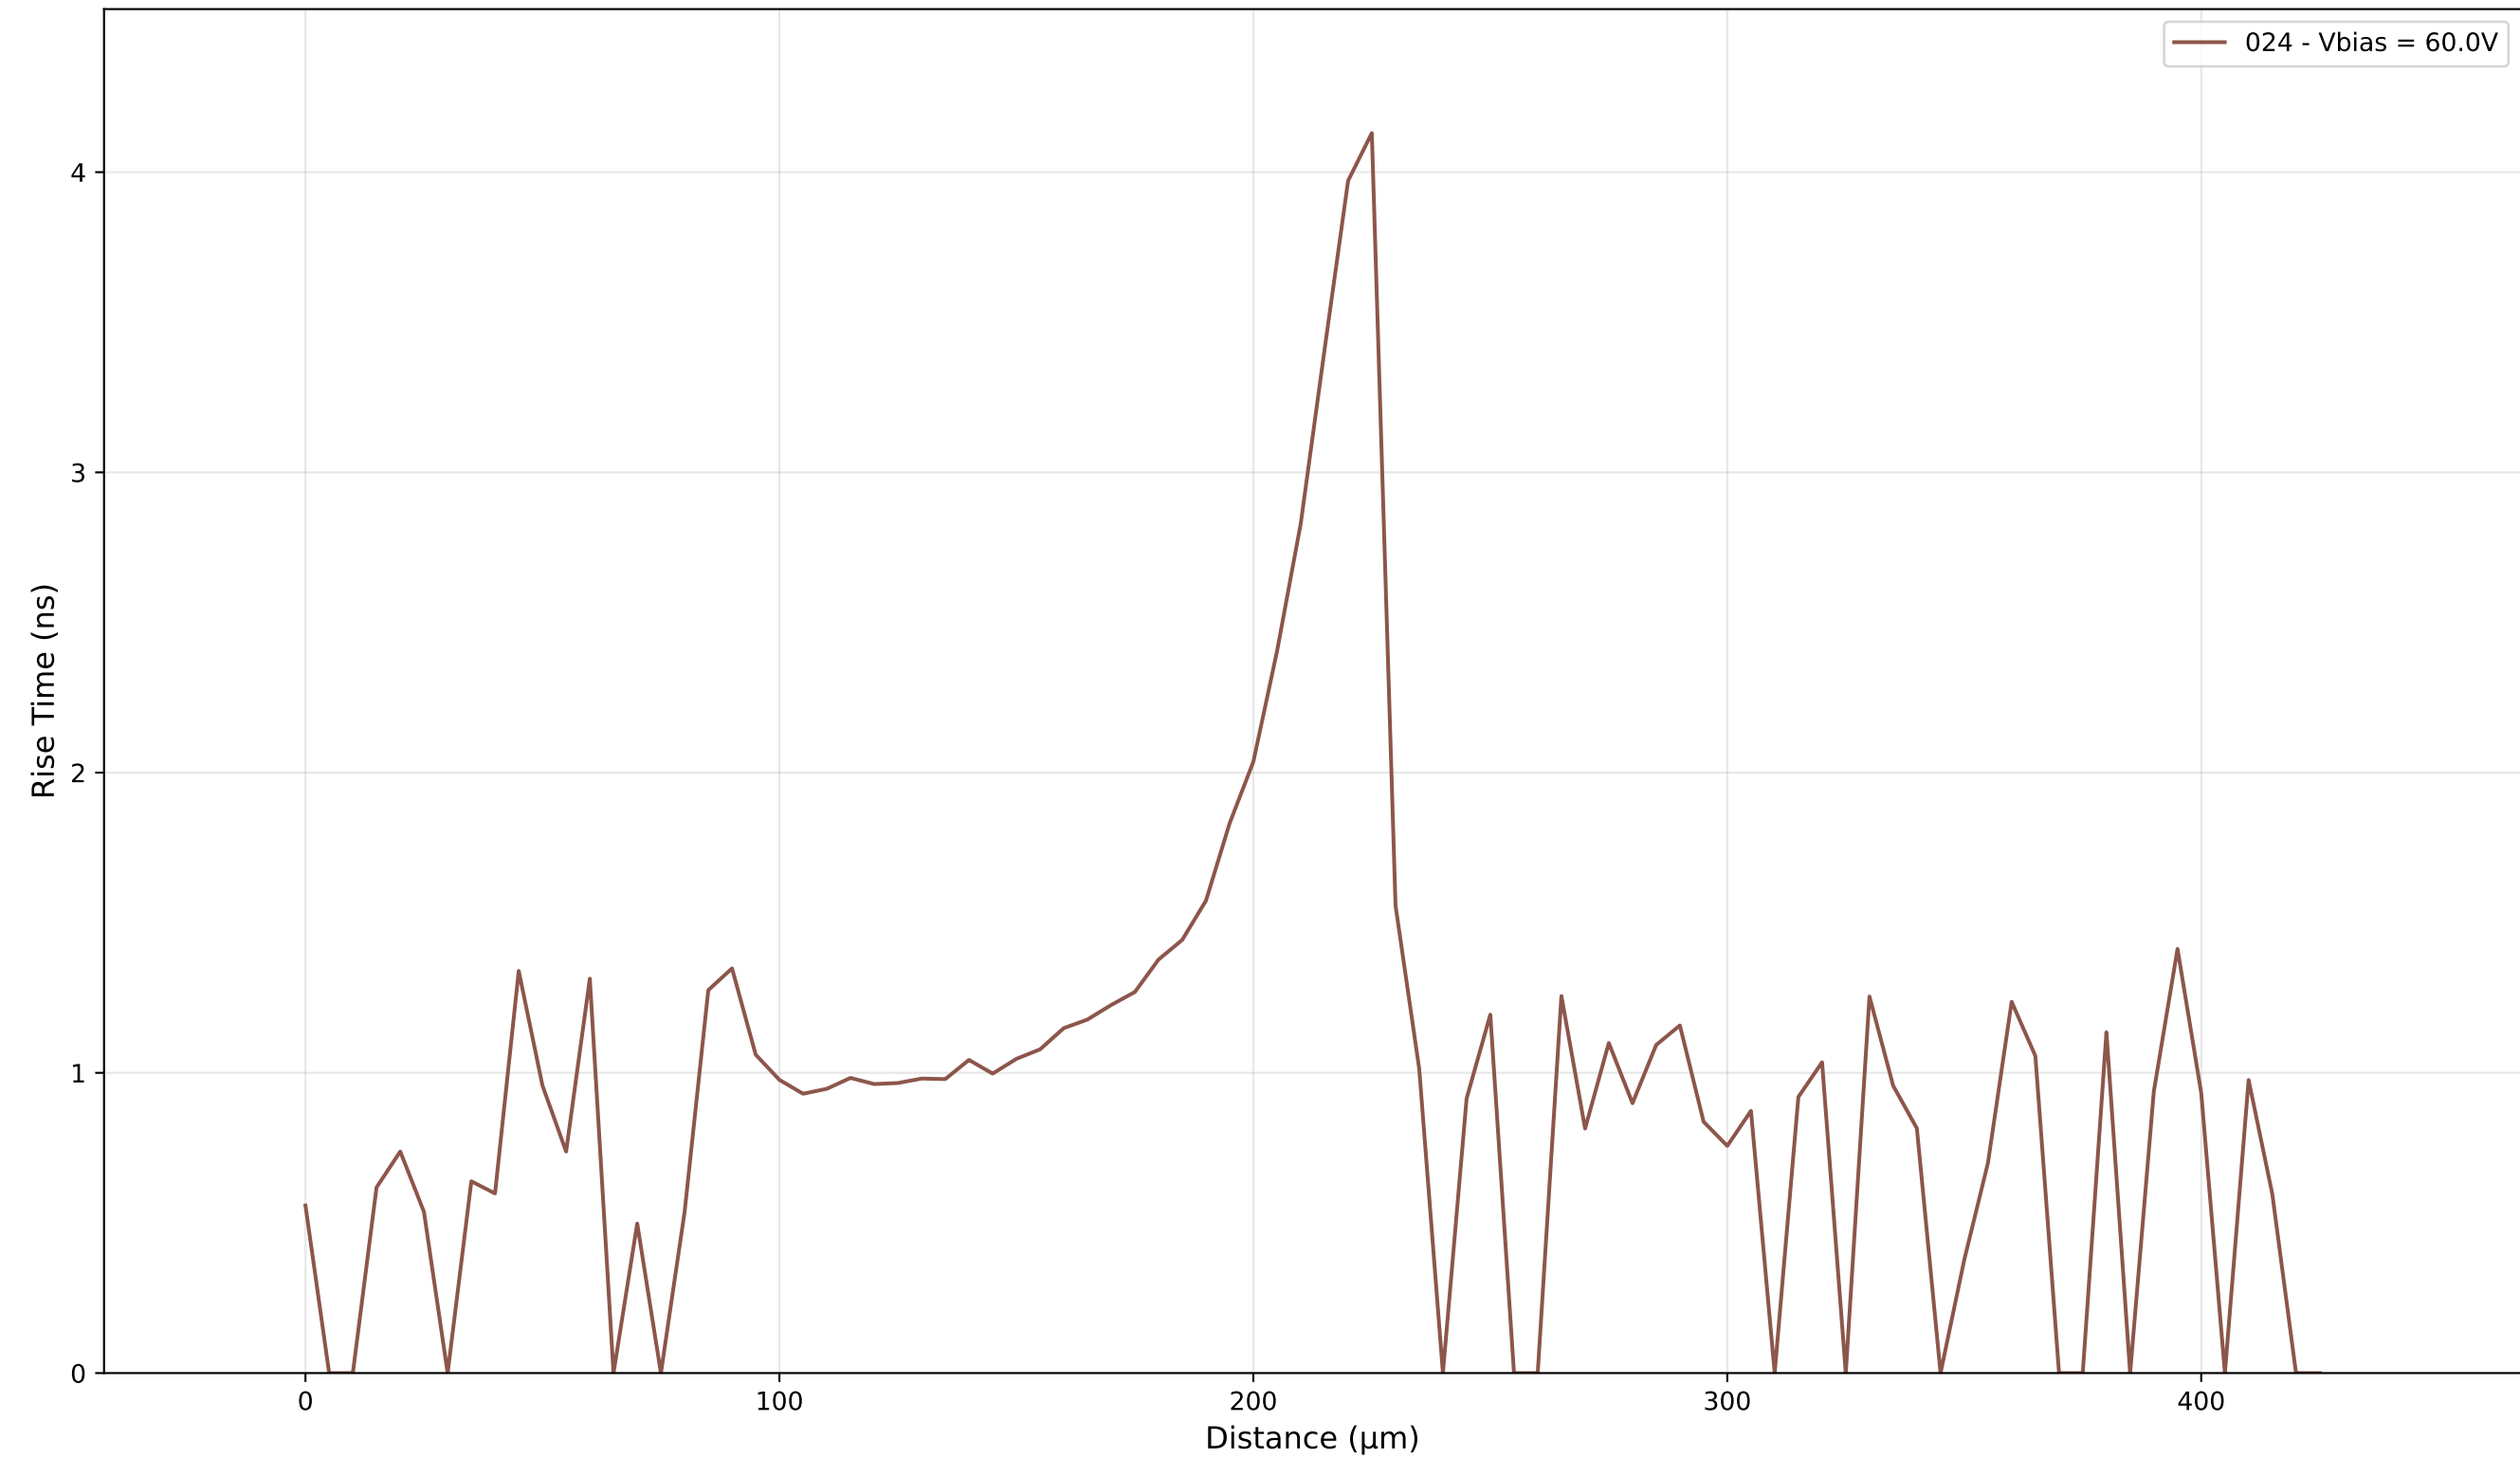


Amplitude

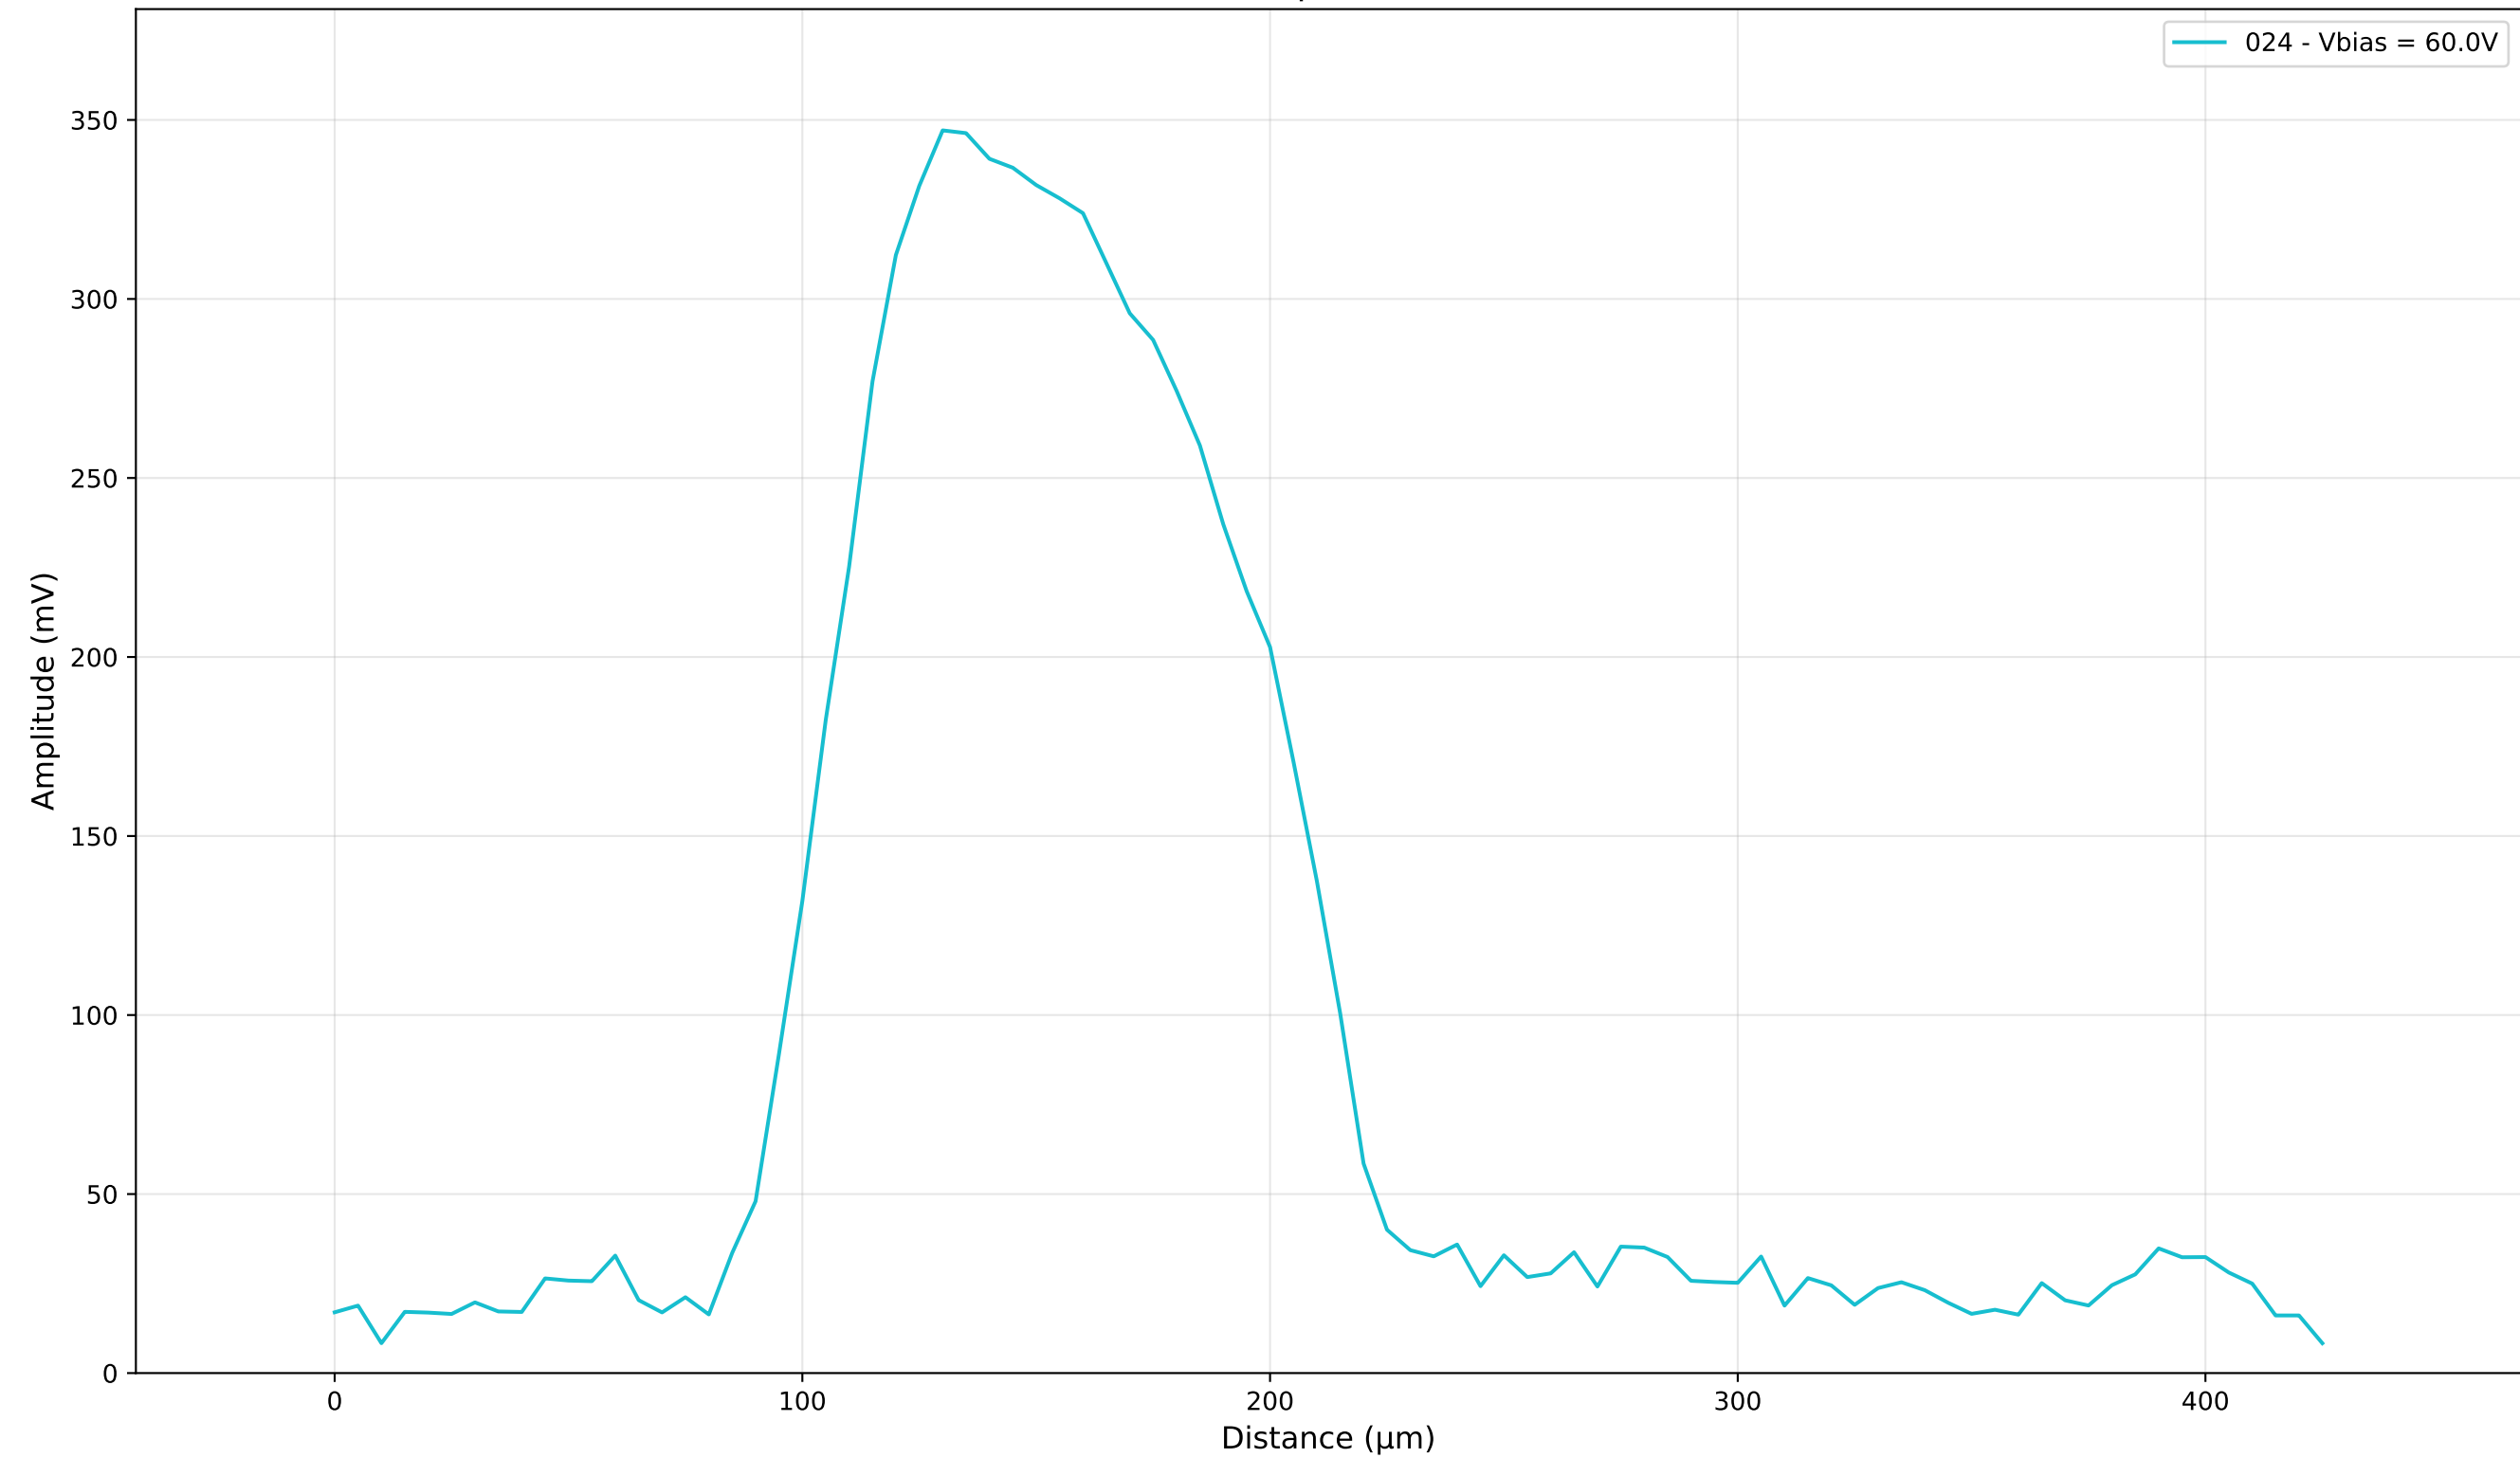


FWHM

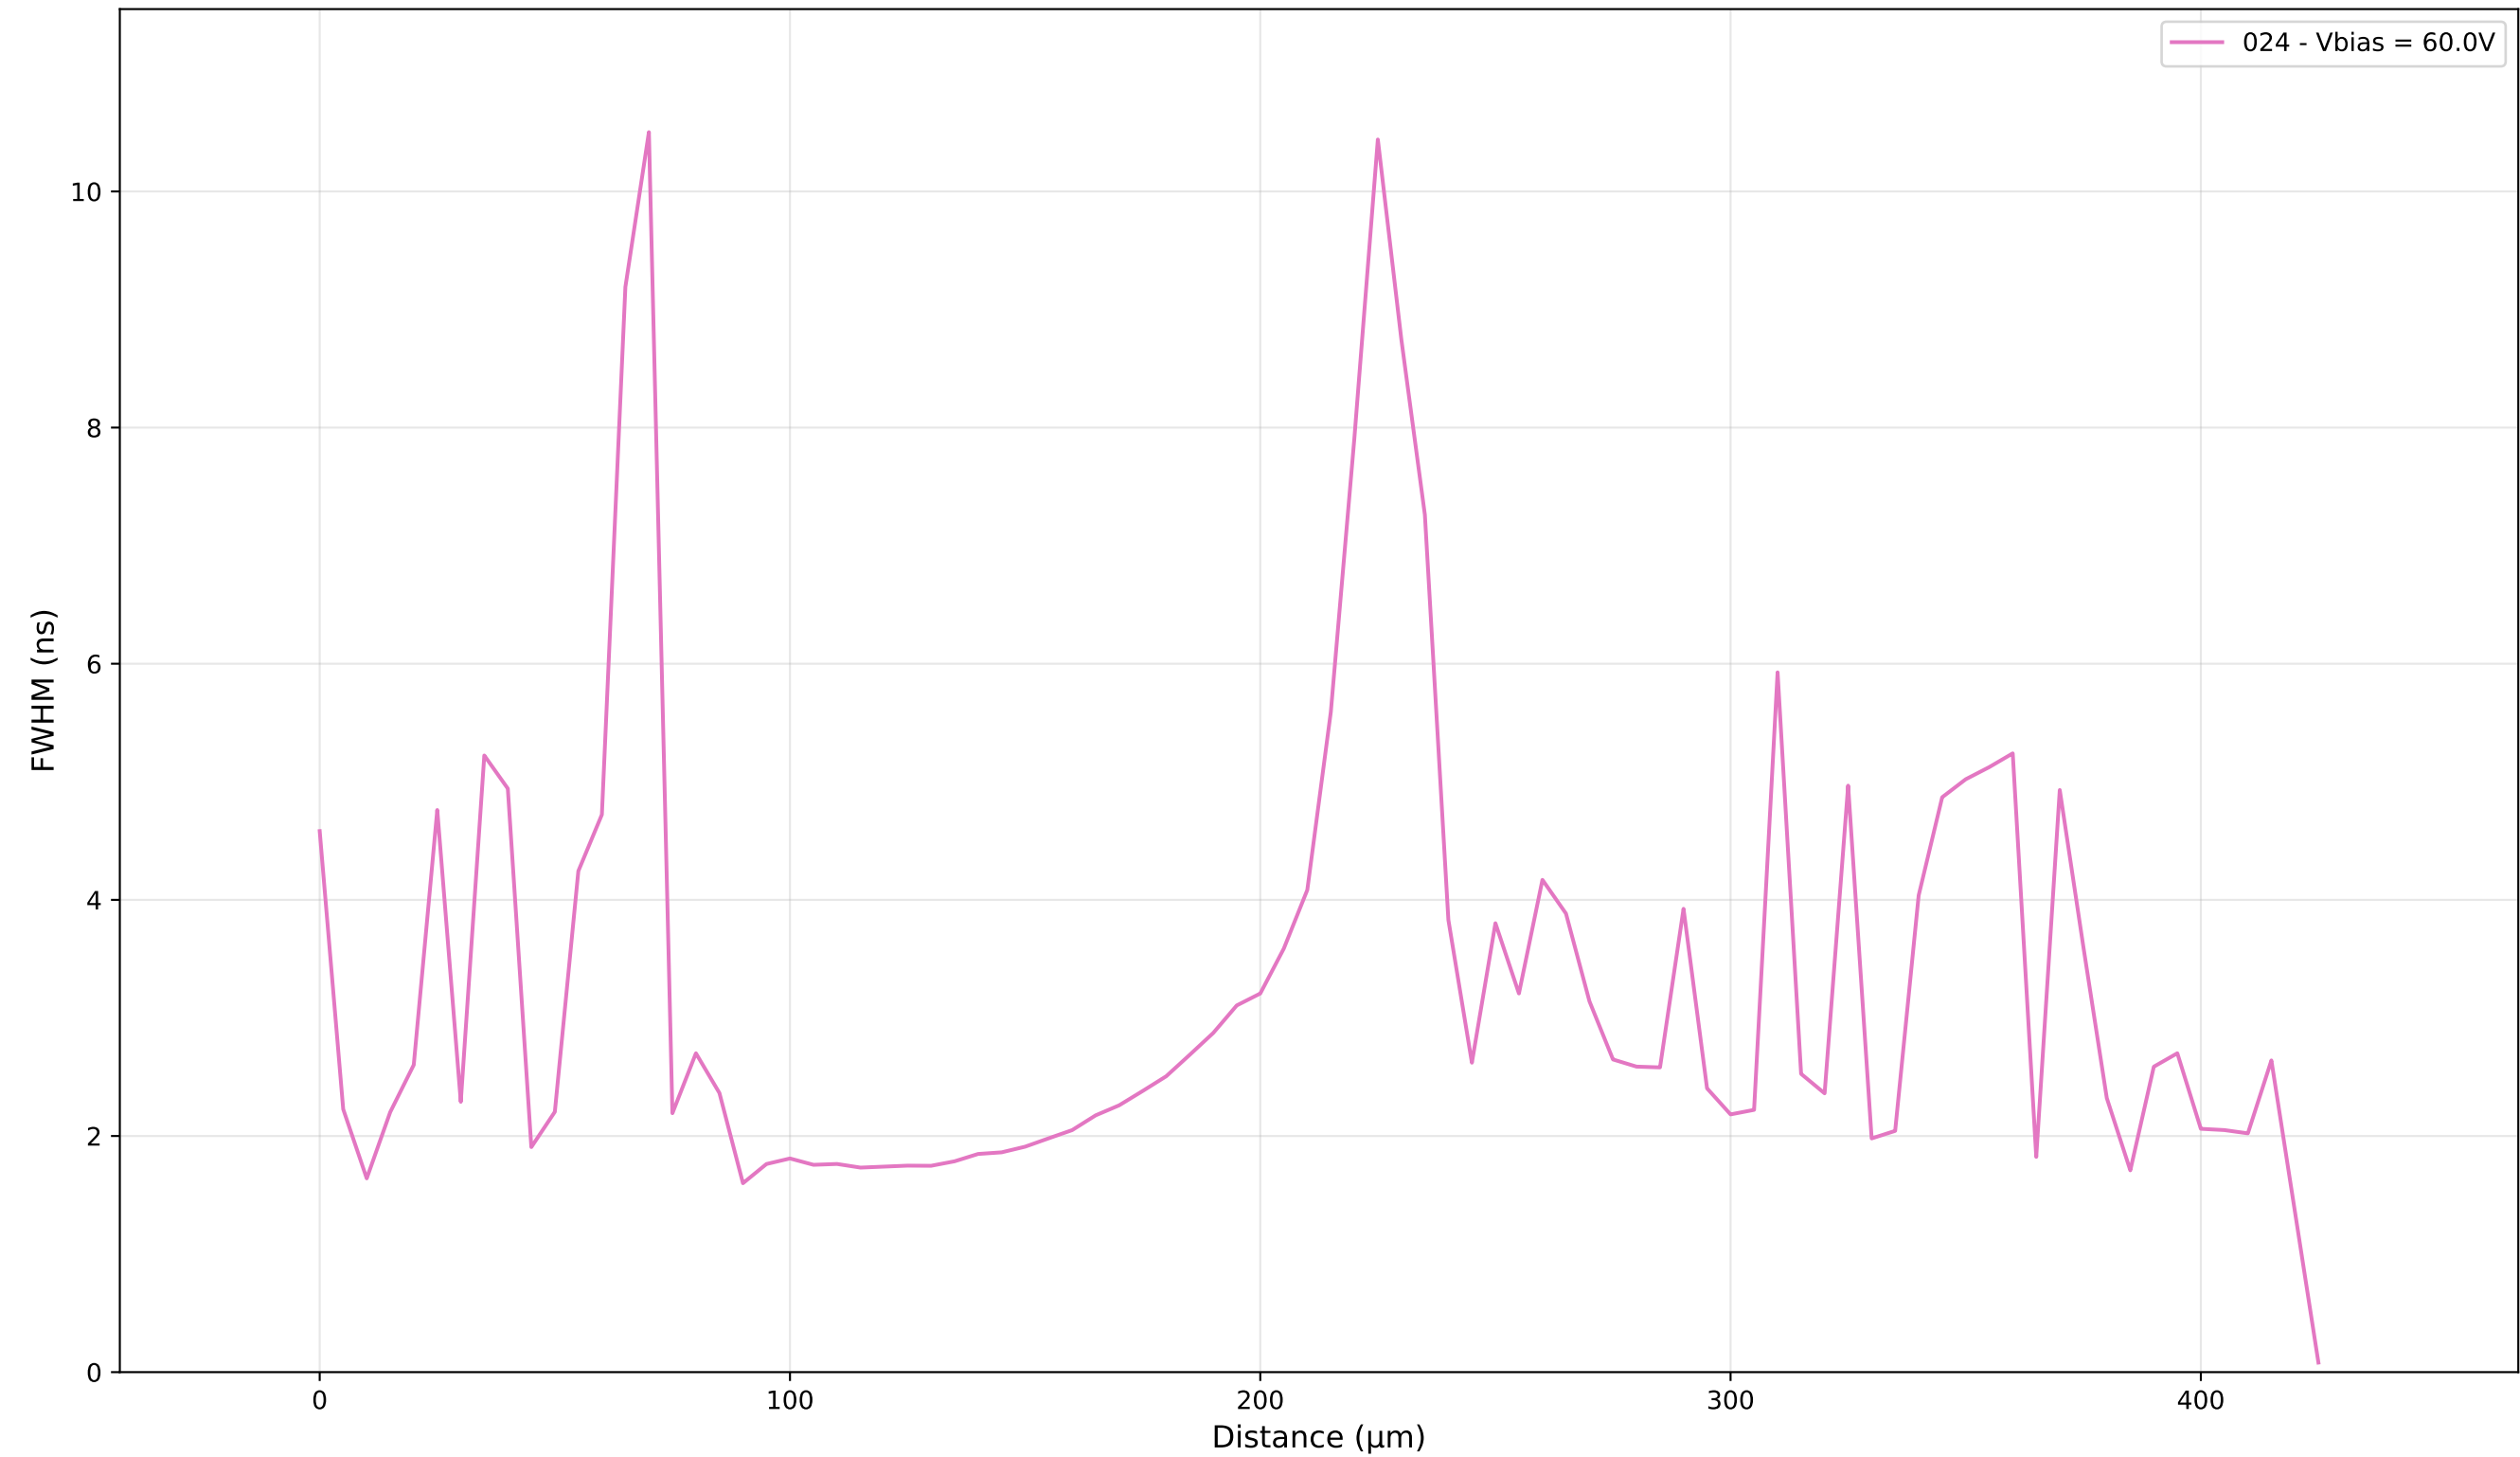


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 1.99 pC - Rise Time: 0.56 ns

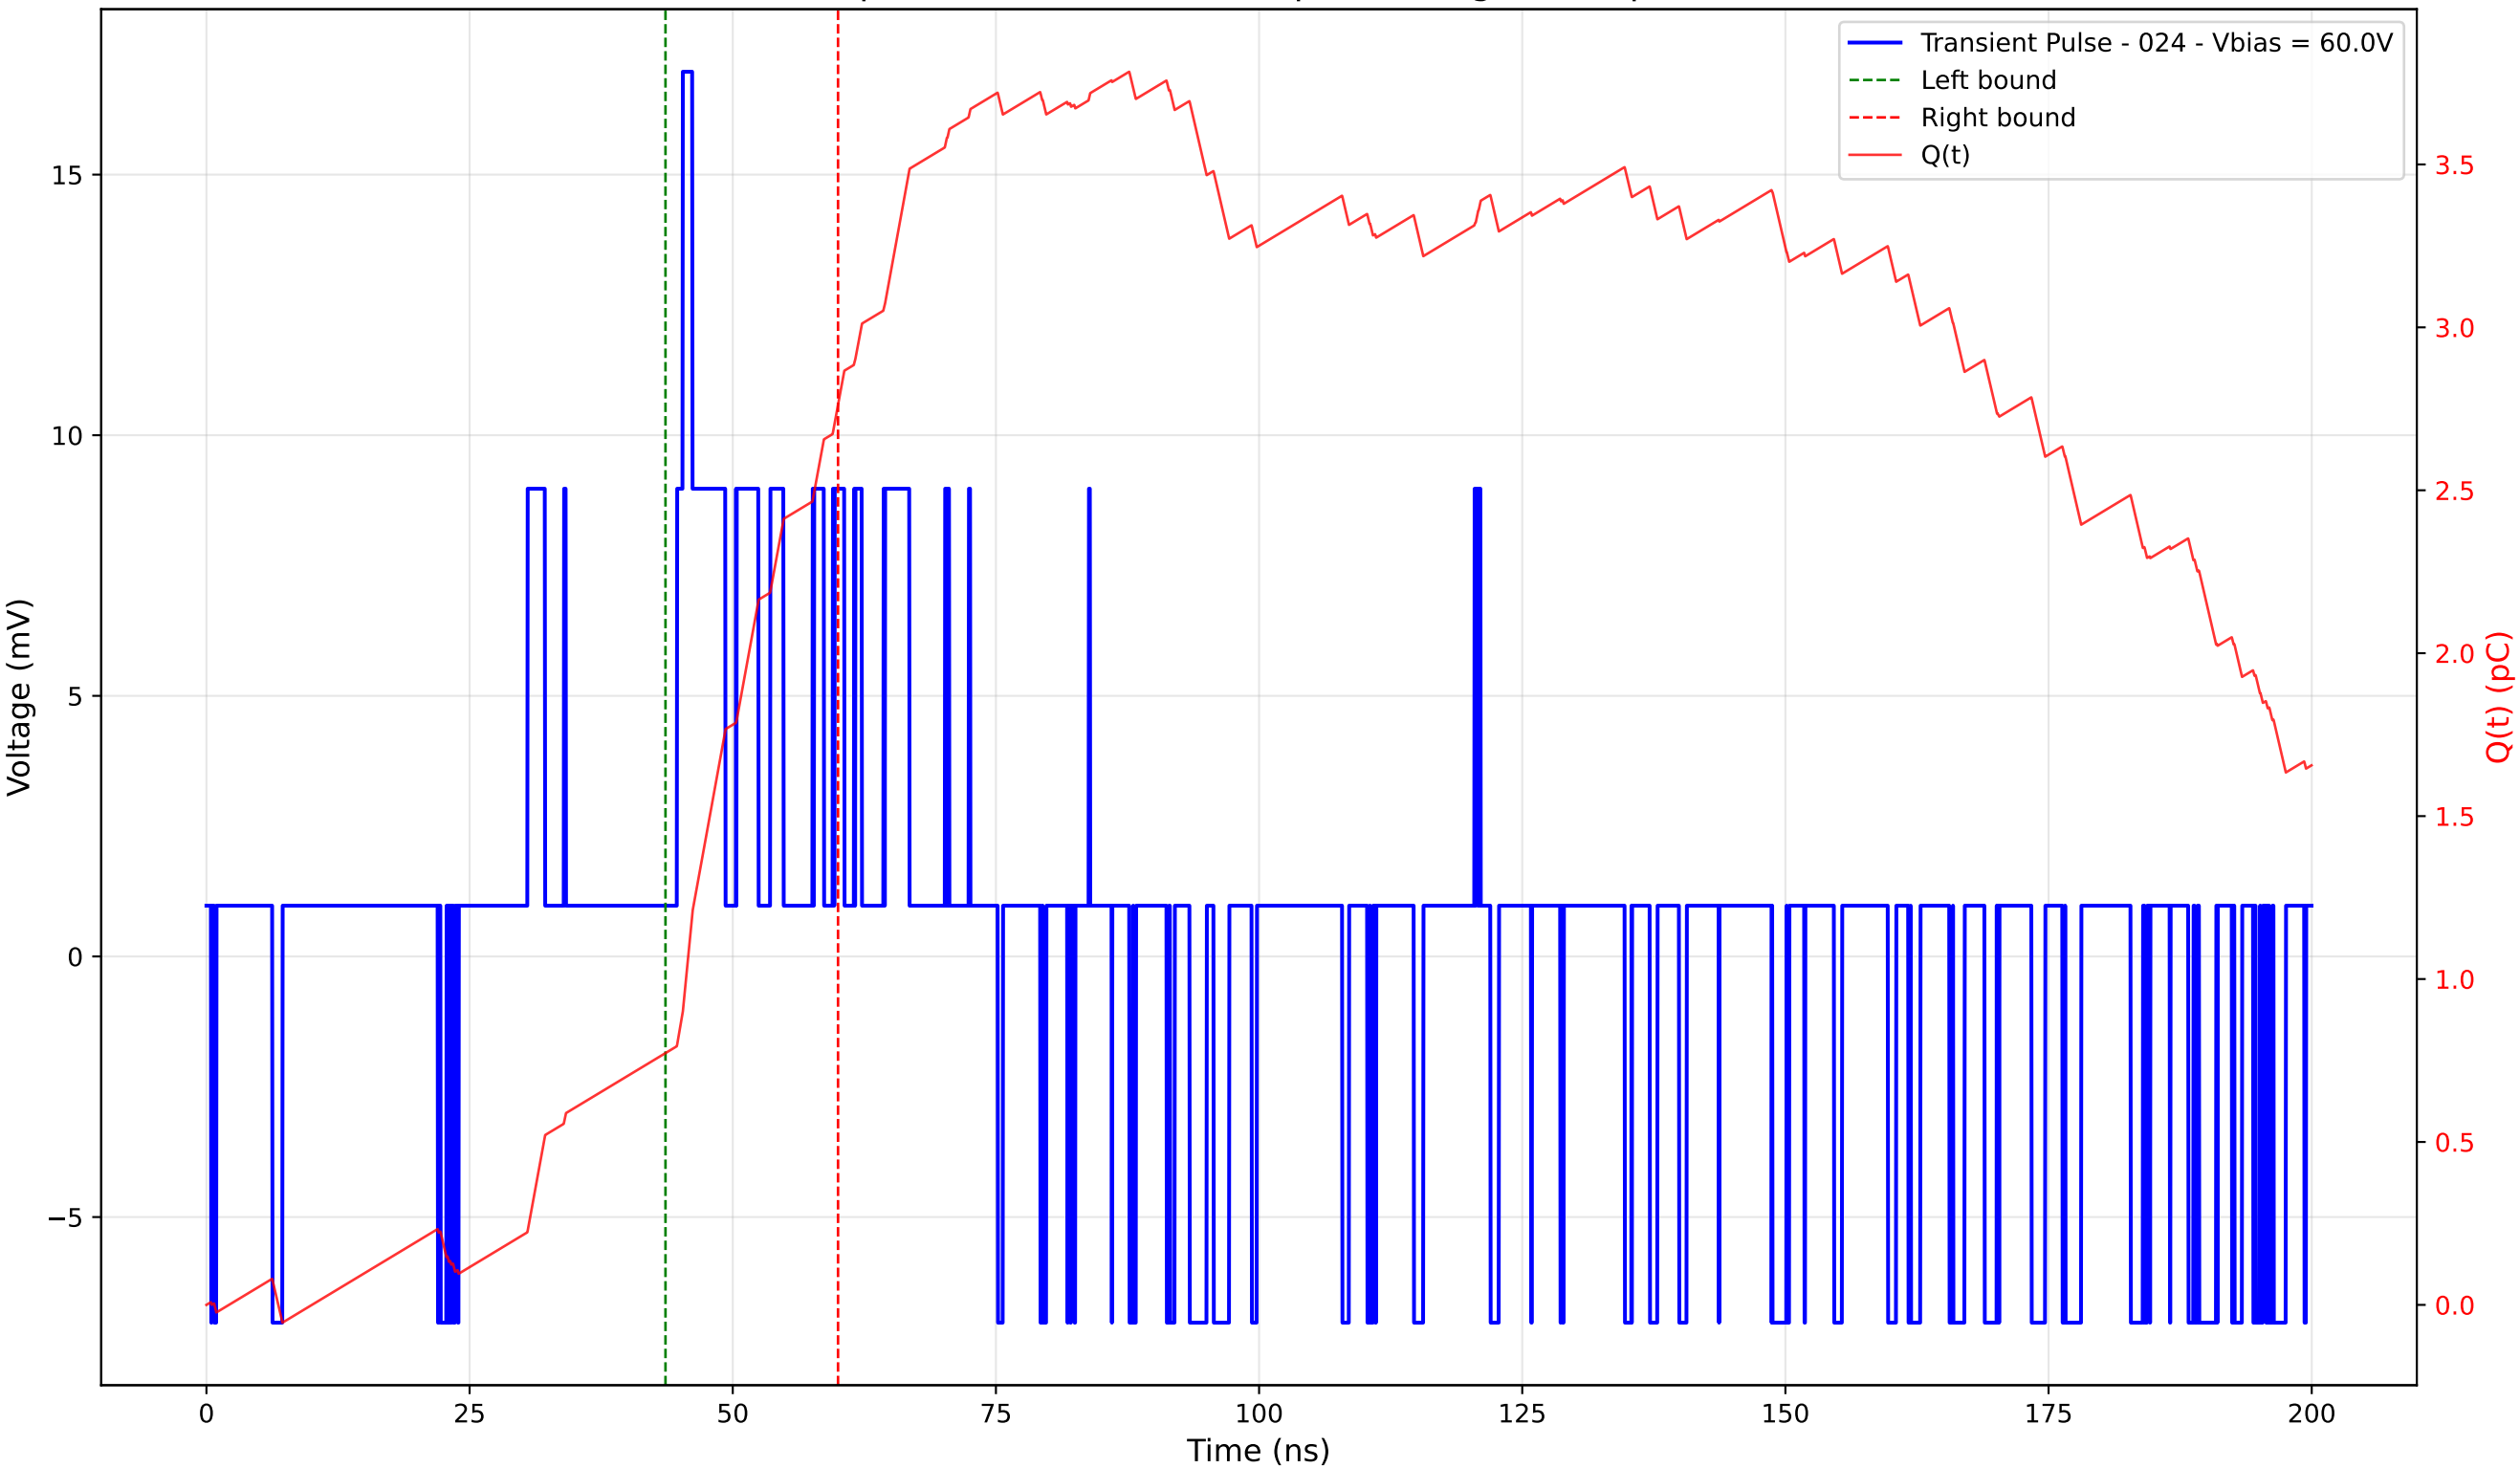


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 2.10 pC - Rise Time: 0.00 ns (N/A)

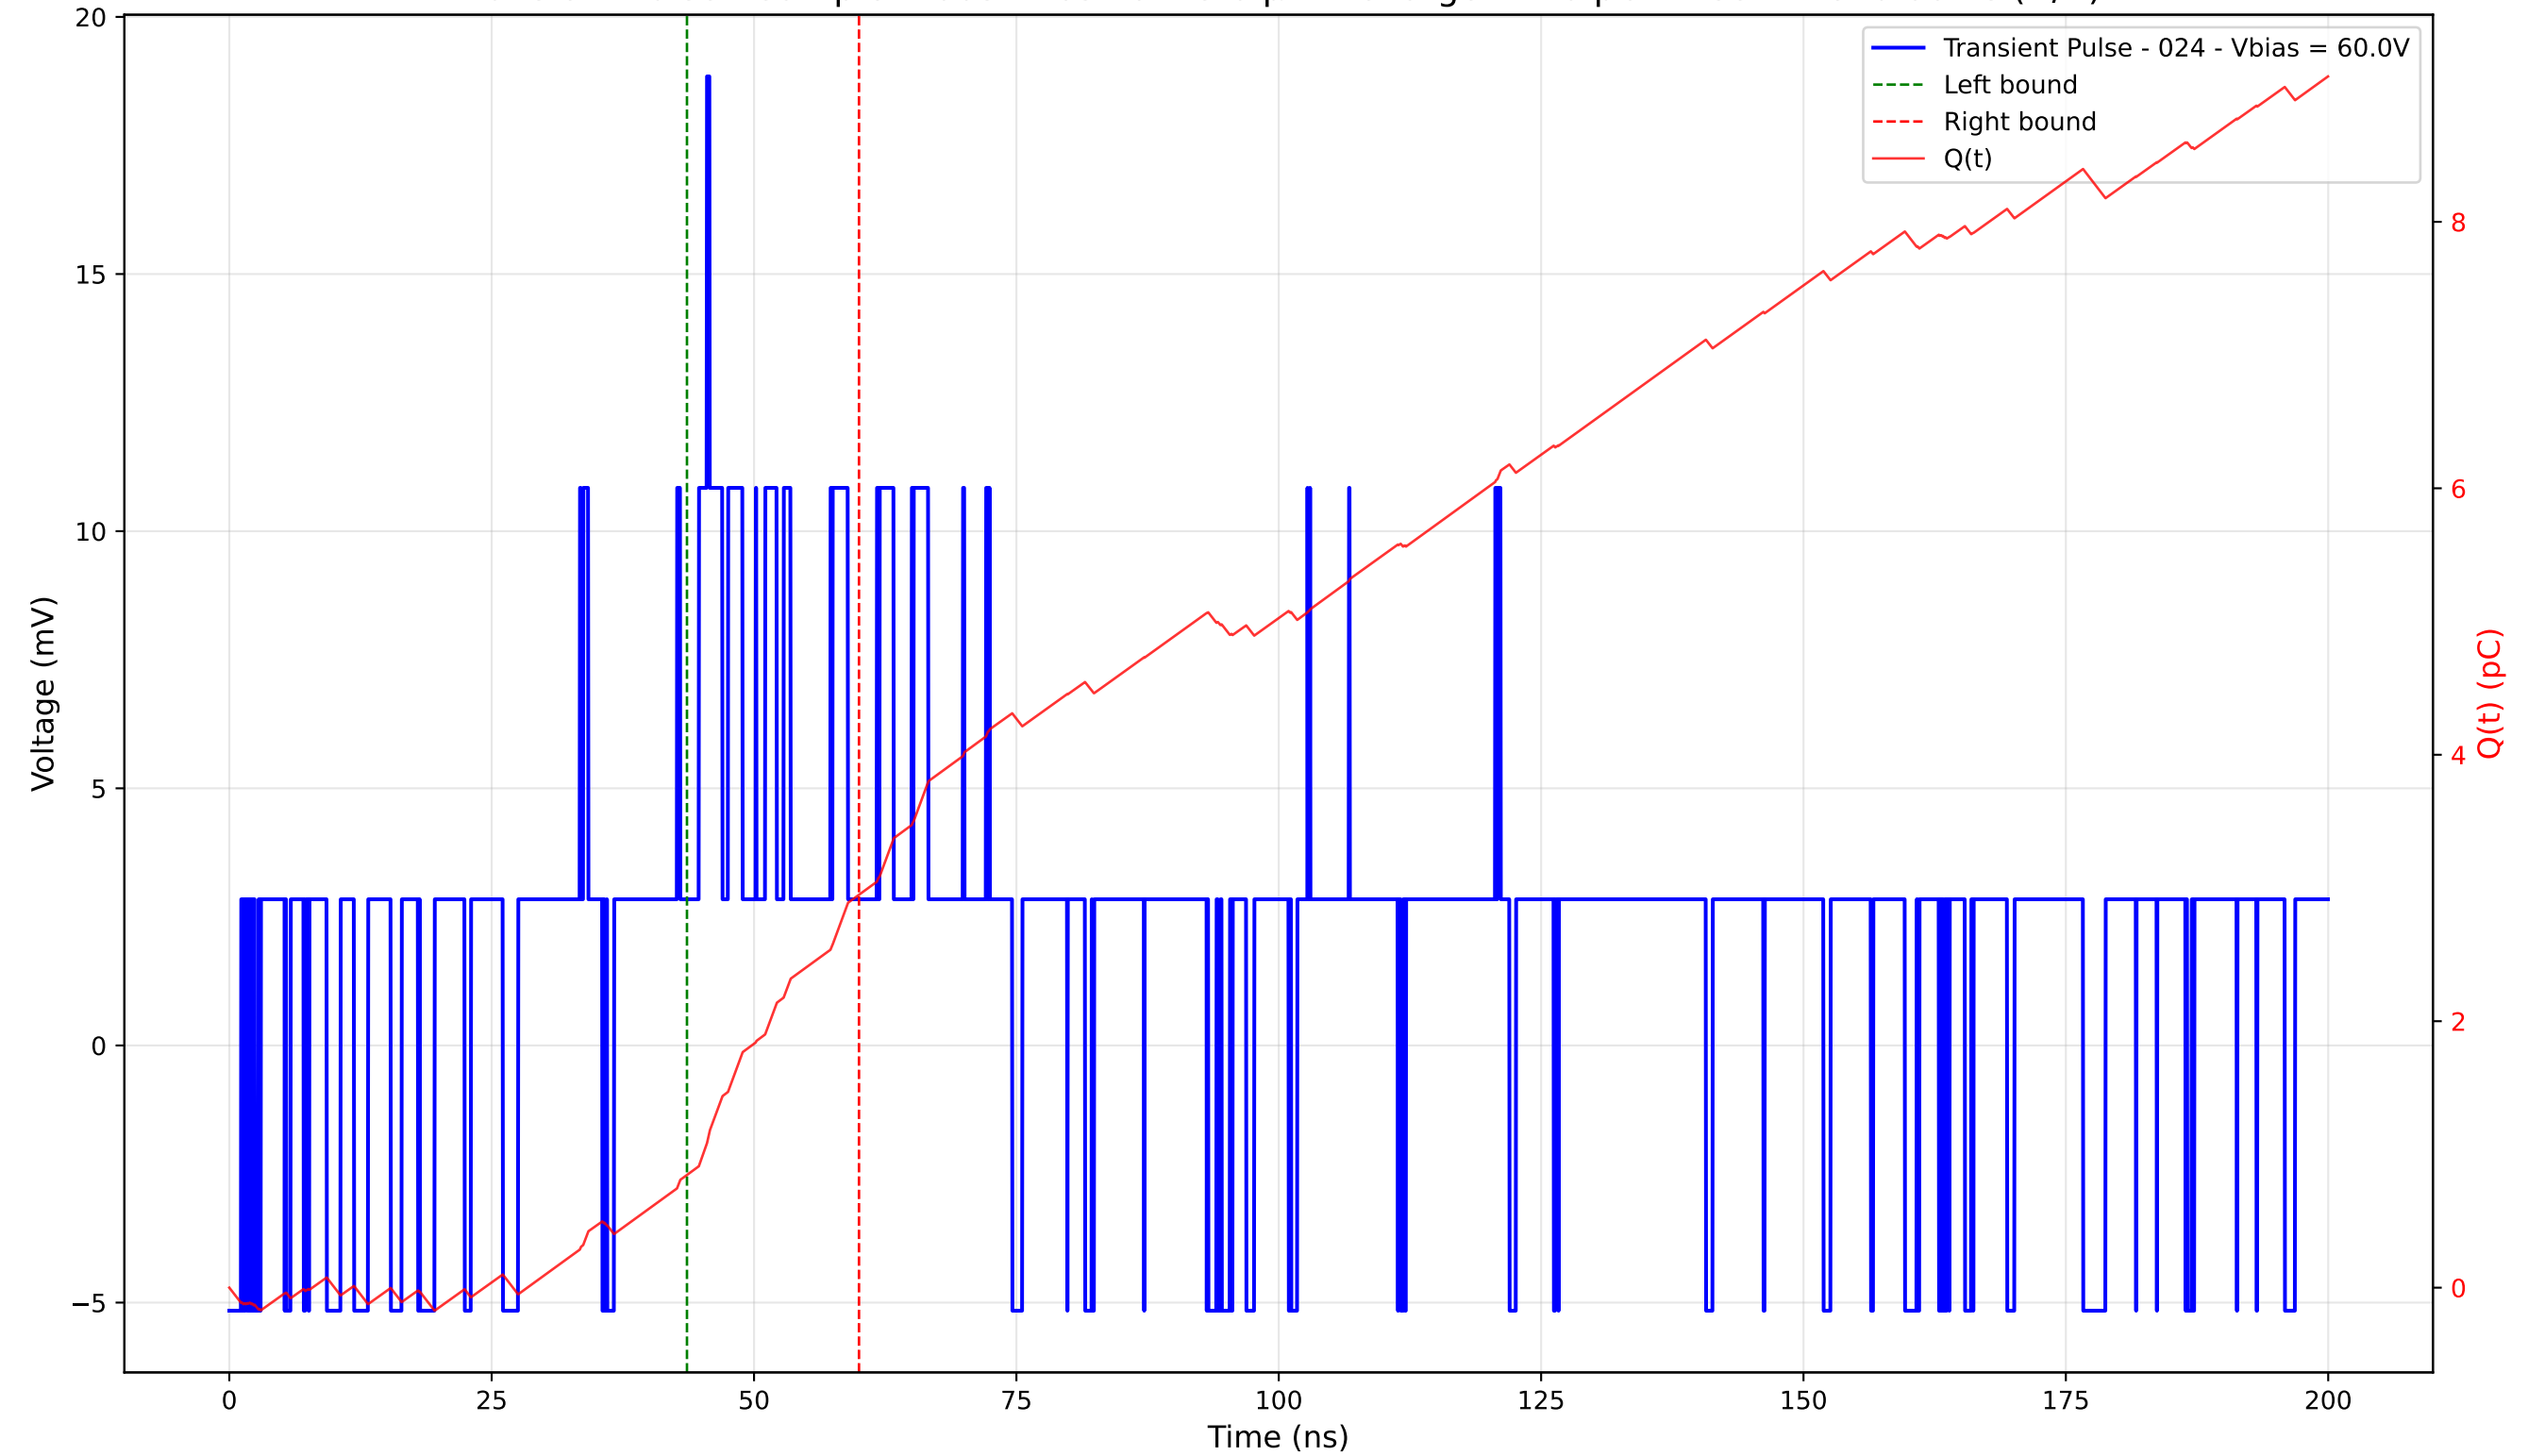


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 1.15 pC - Rise Time: 0.00 ns (N/A)

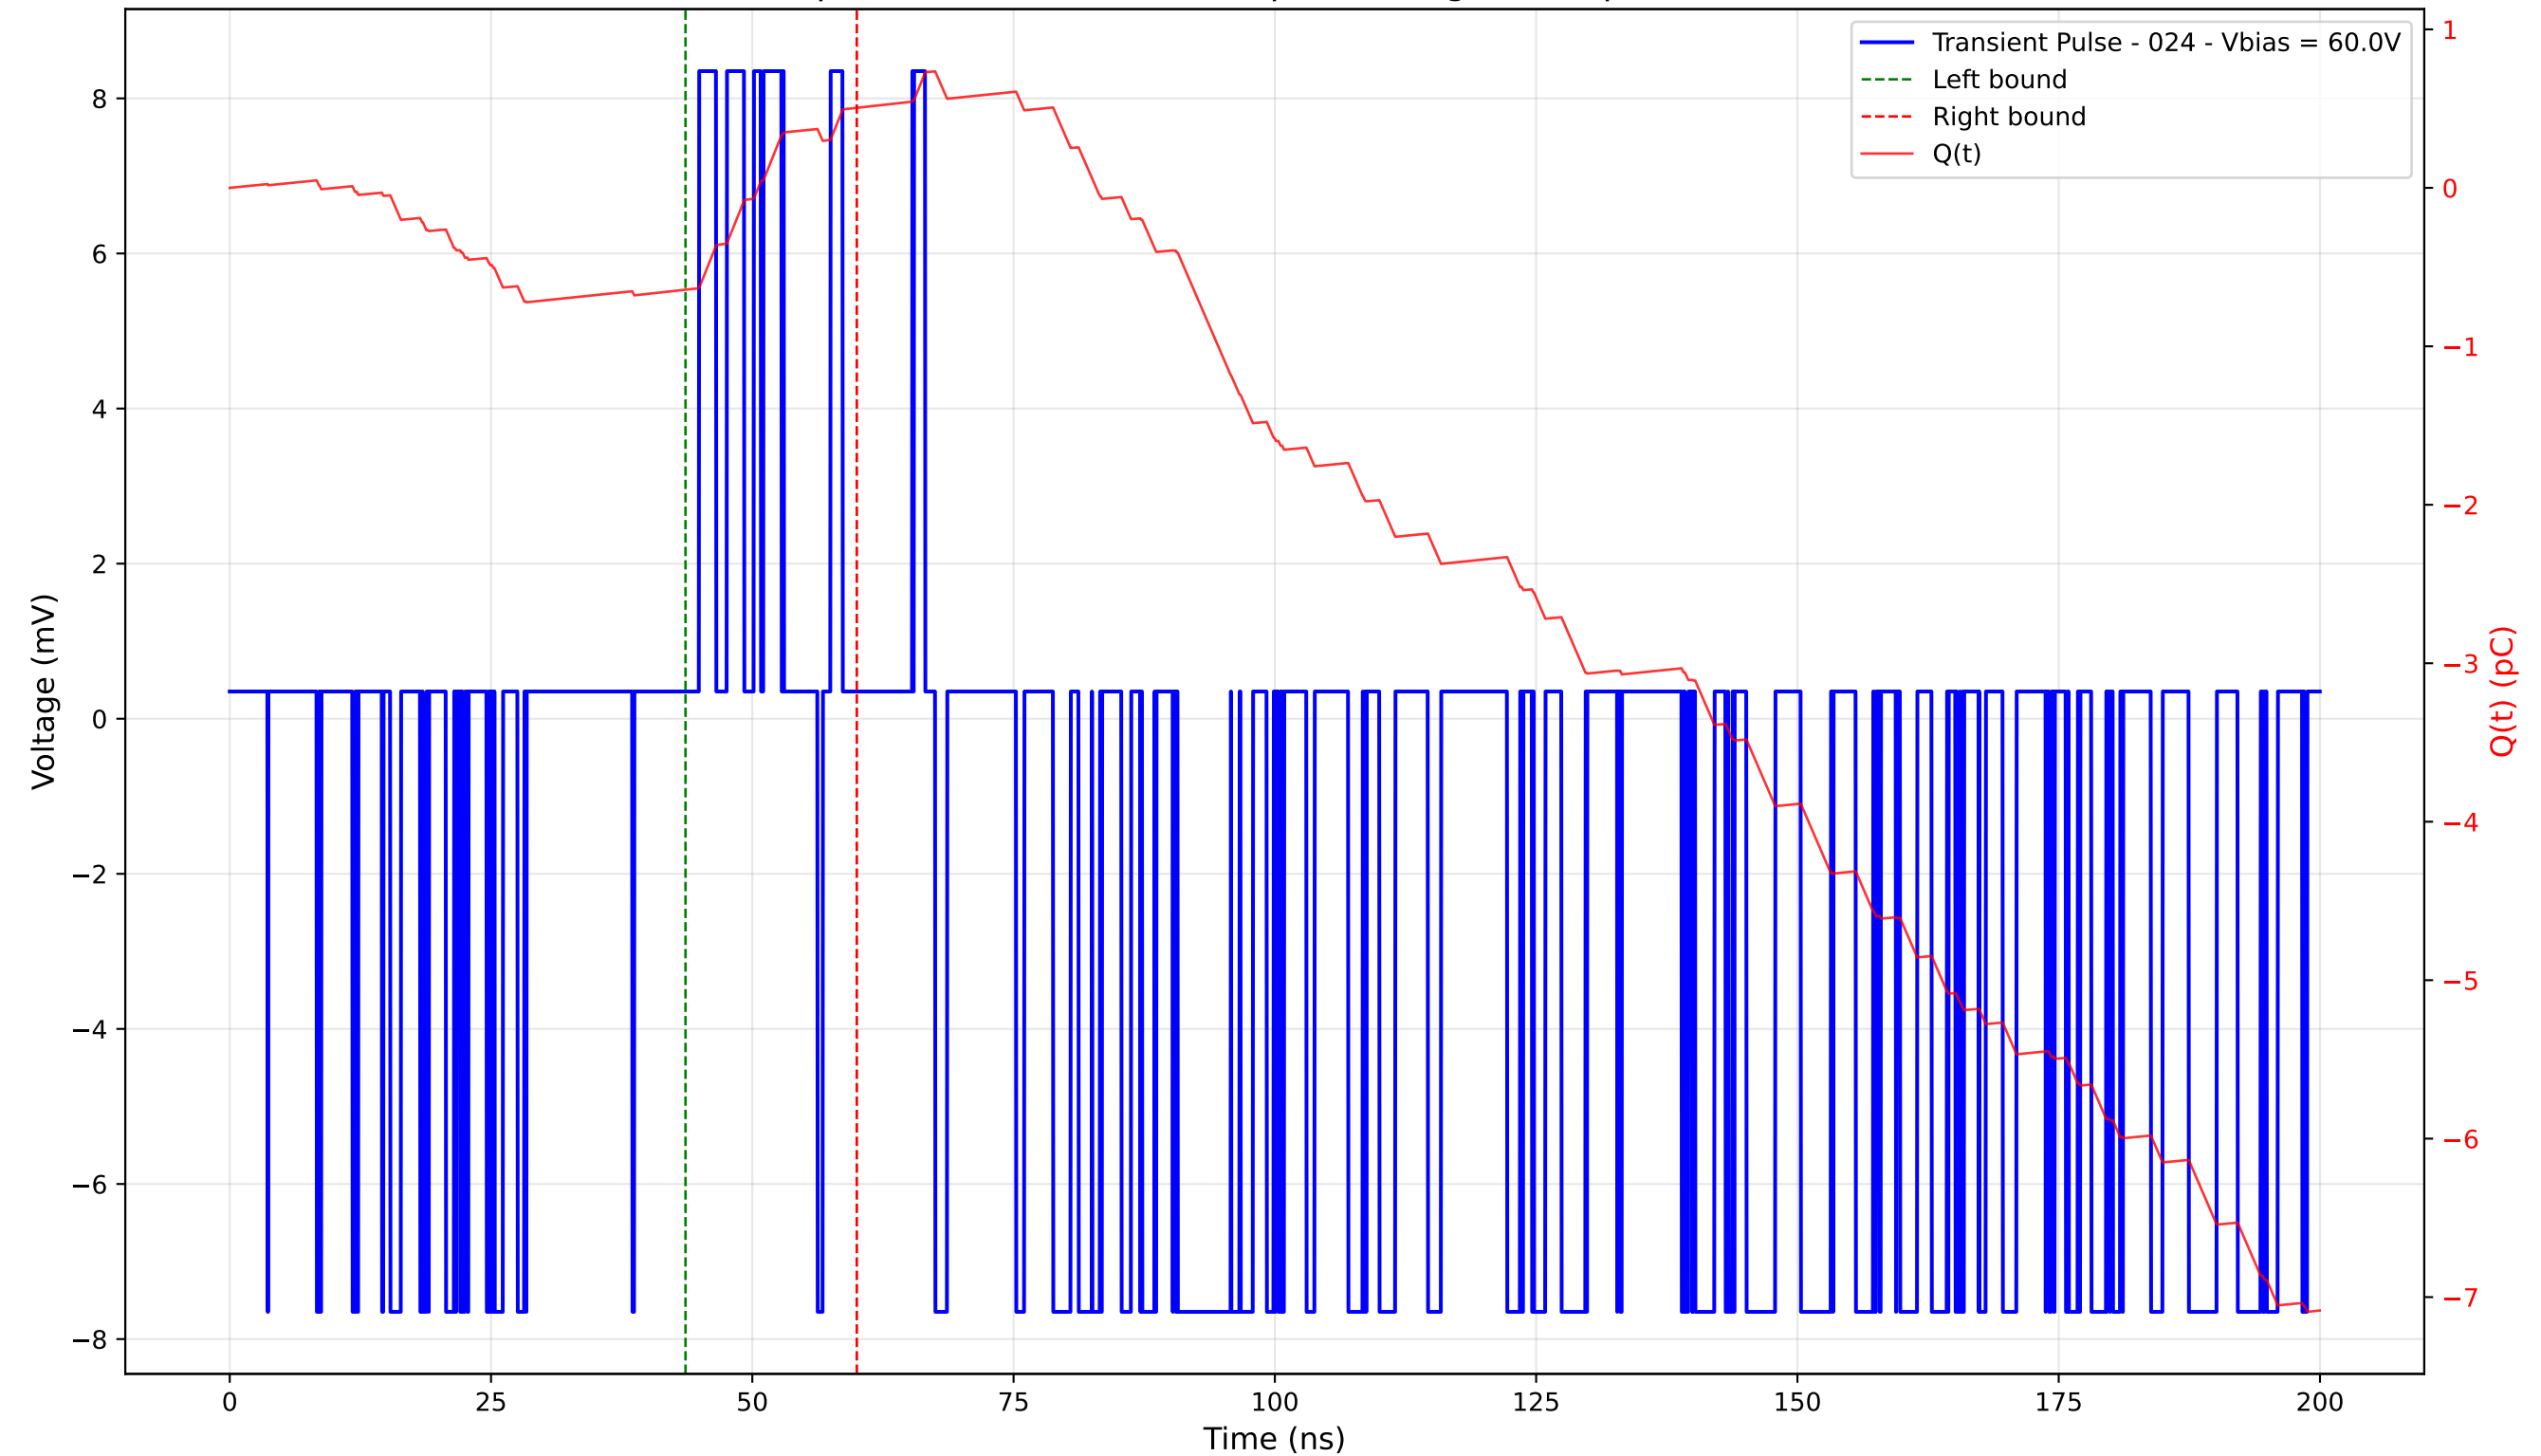


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.58 pC - Rise Time: 0.62 ns

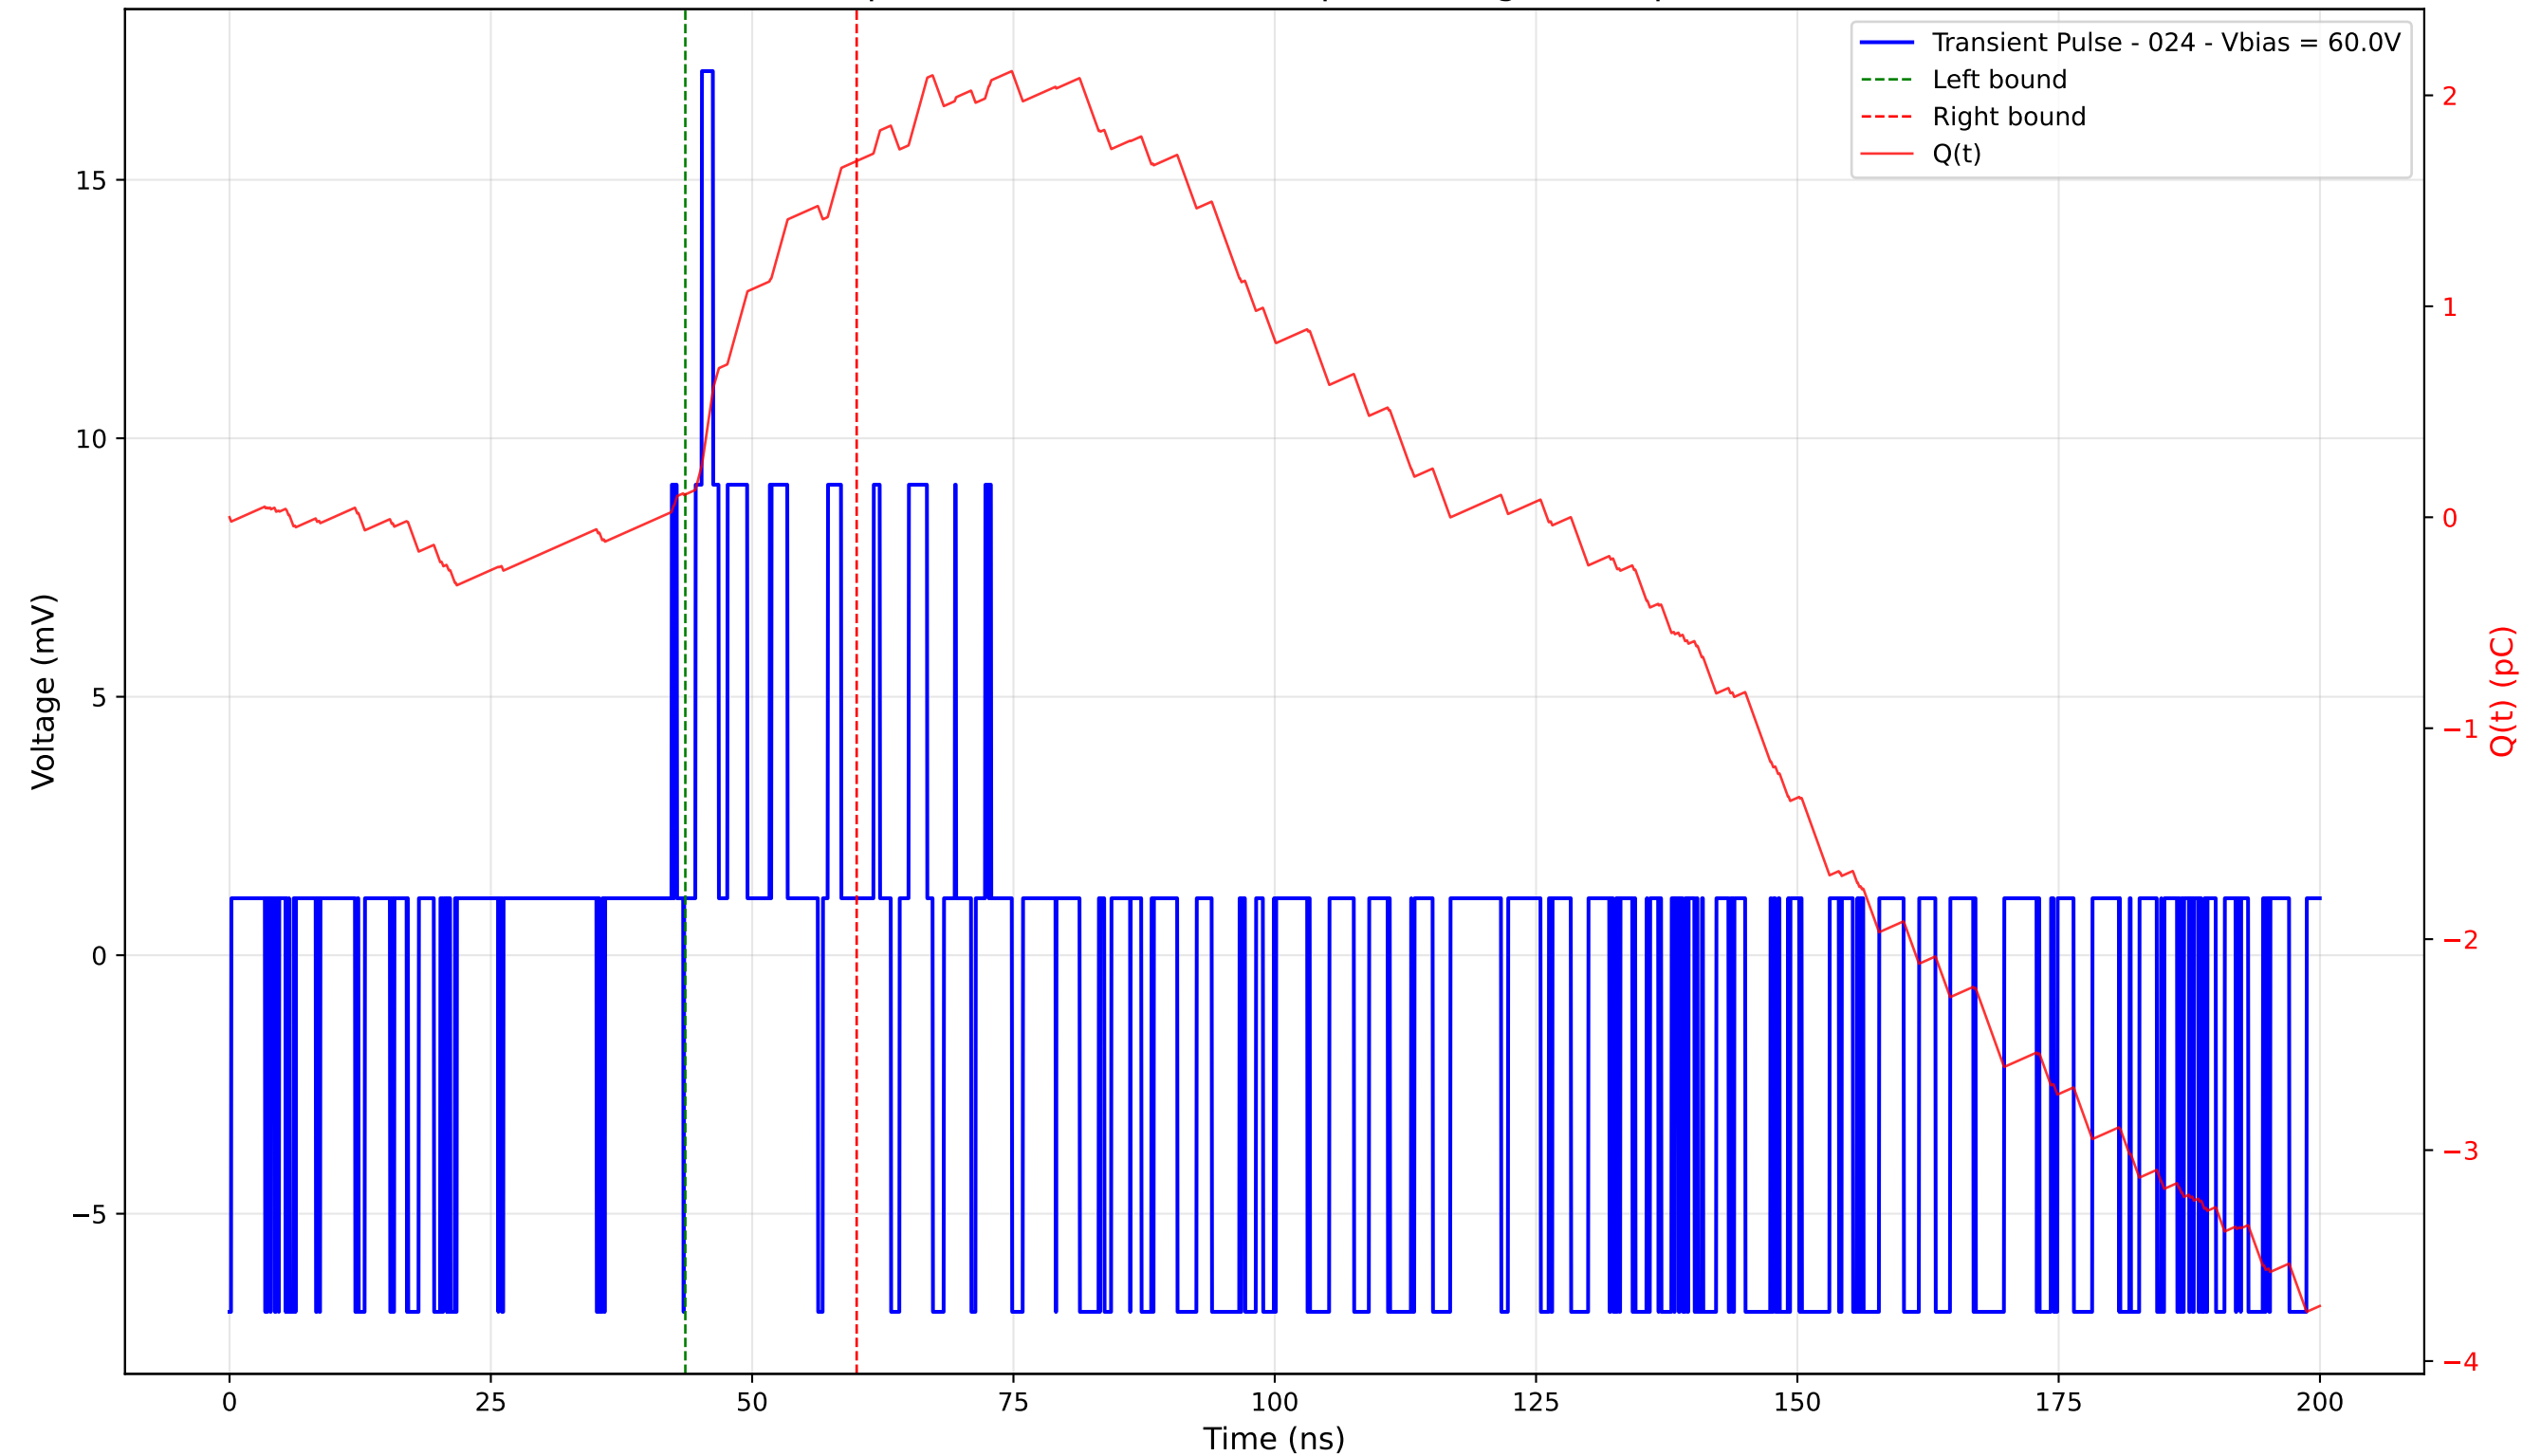


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.97 pC - Rise Time: 0.74 ns

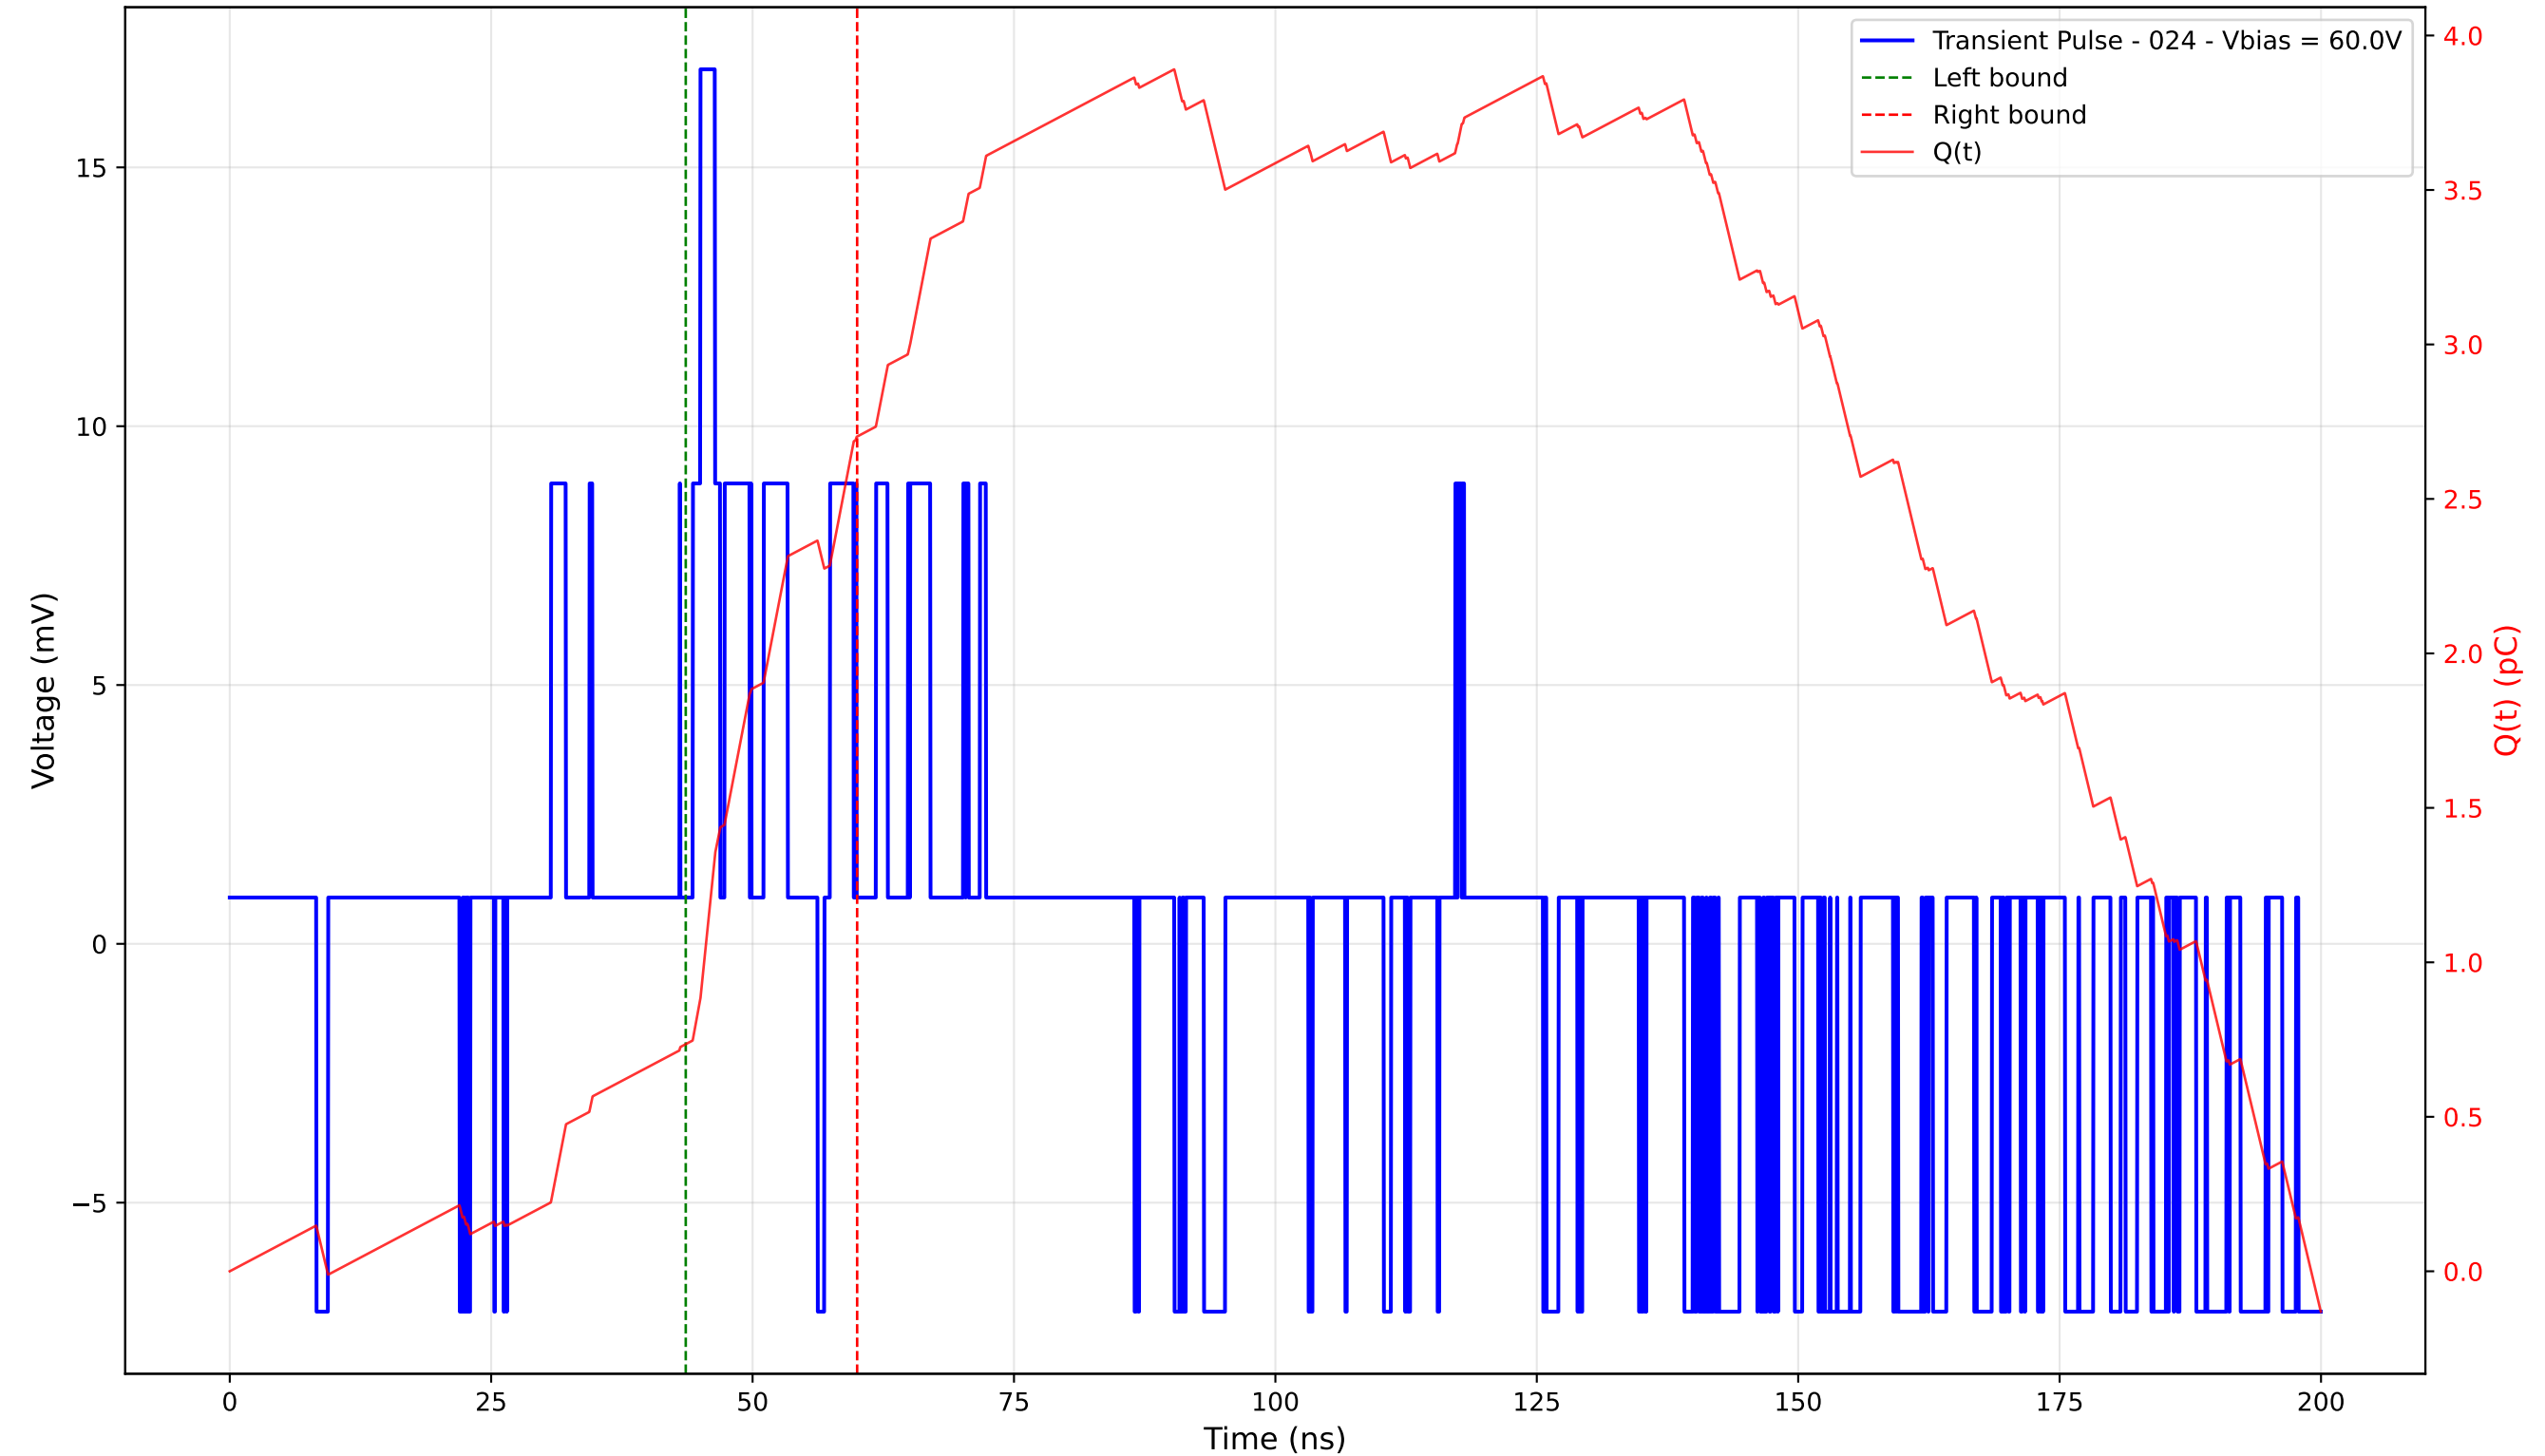


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 2.15 pC - Rise Time: 0.54 ns

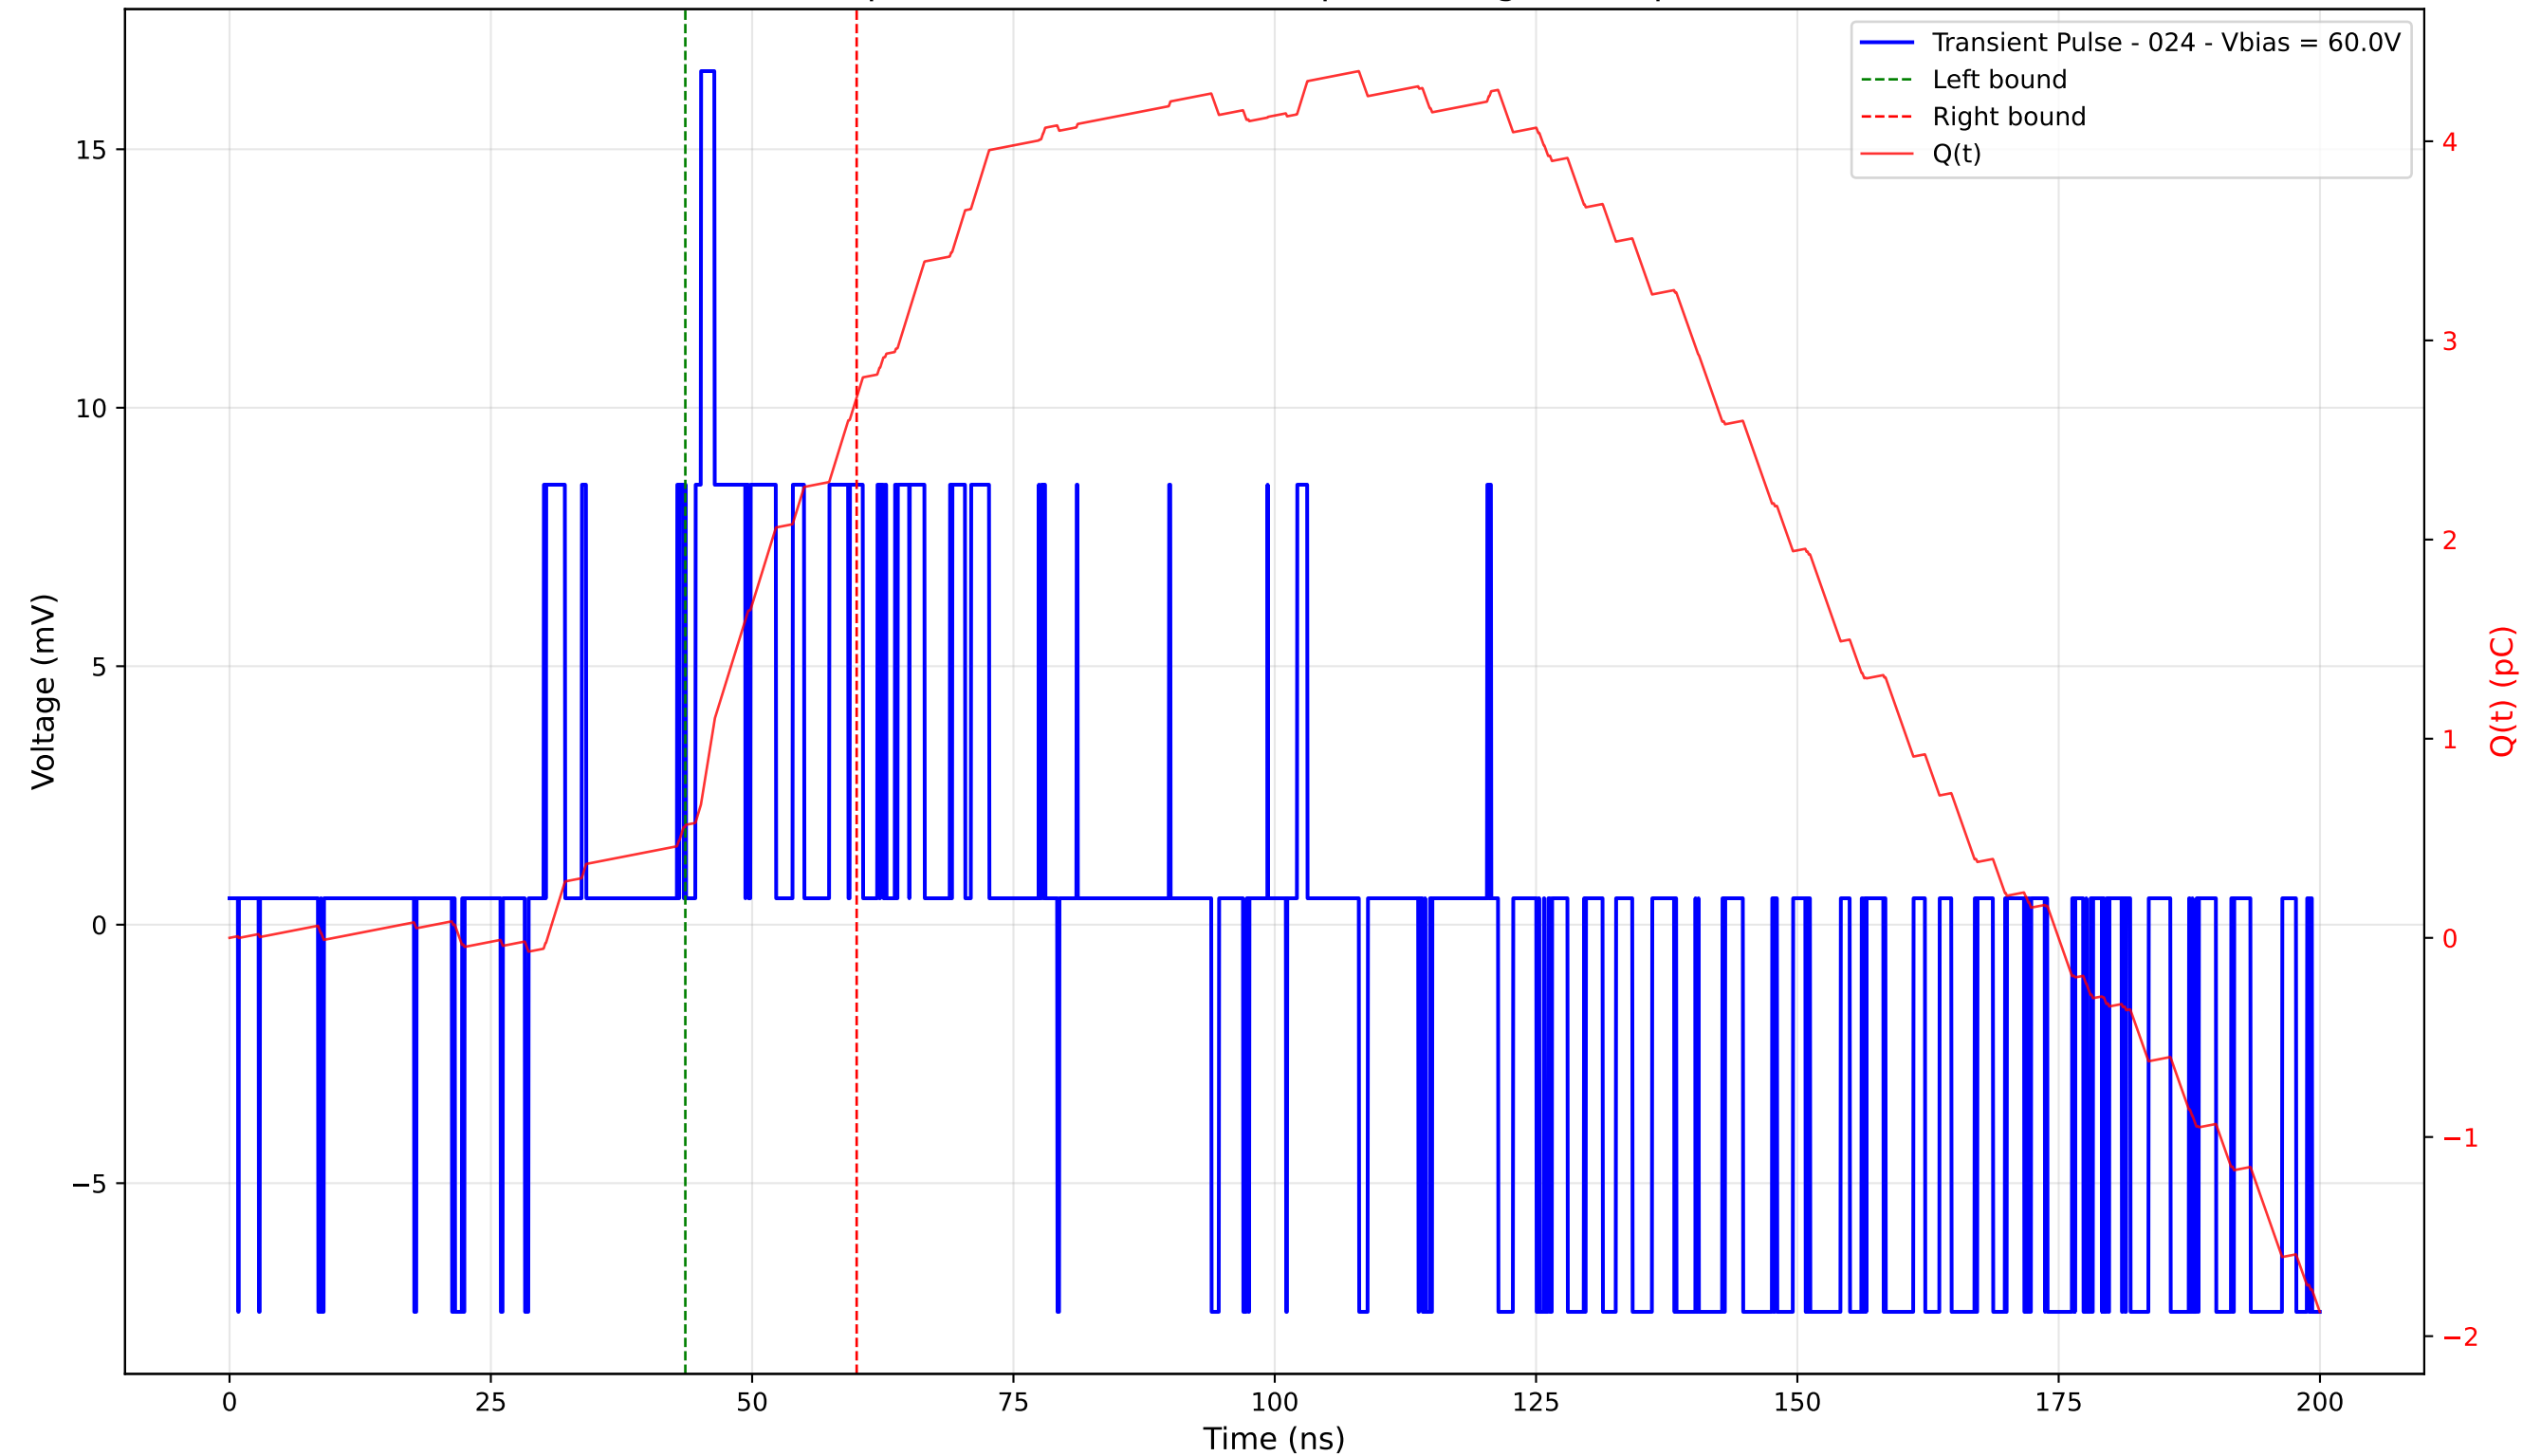


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 2.13 pC - Rise Time: 0.00 ns (N/A)

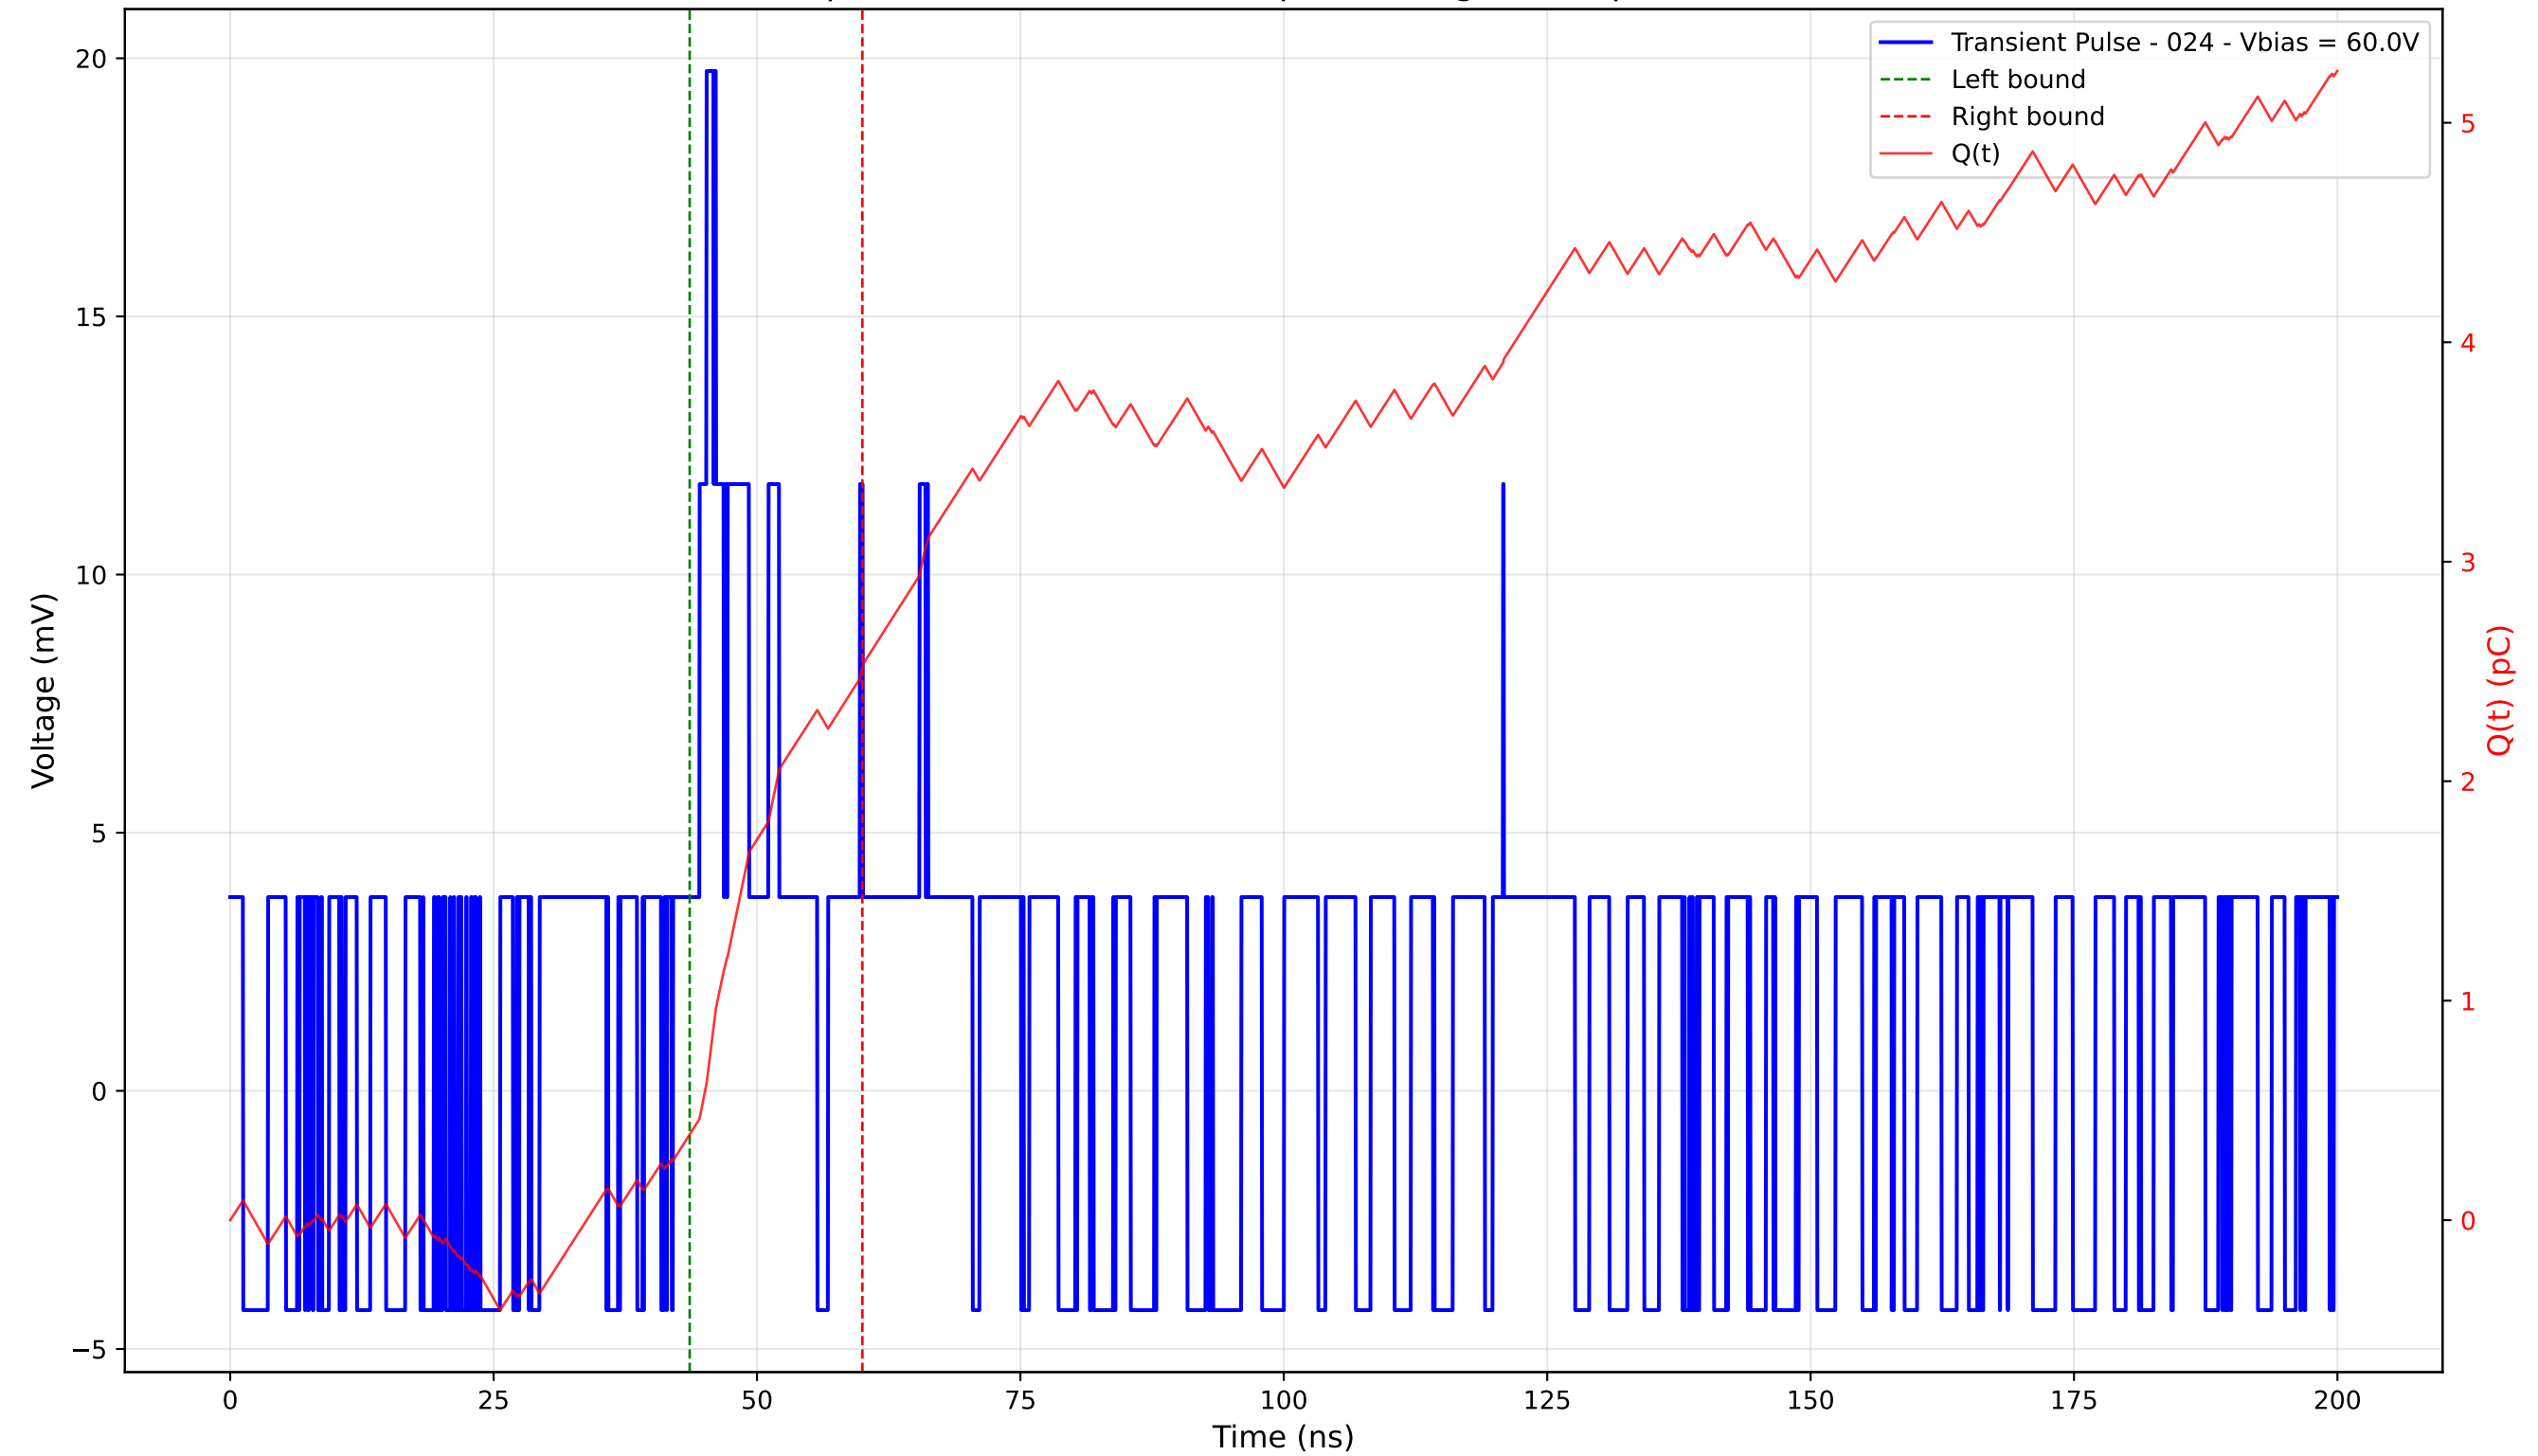


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.87 pC - Rise Time: 0.64 ns

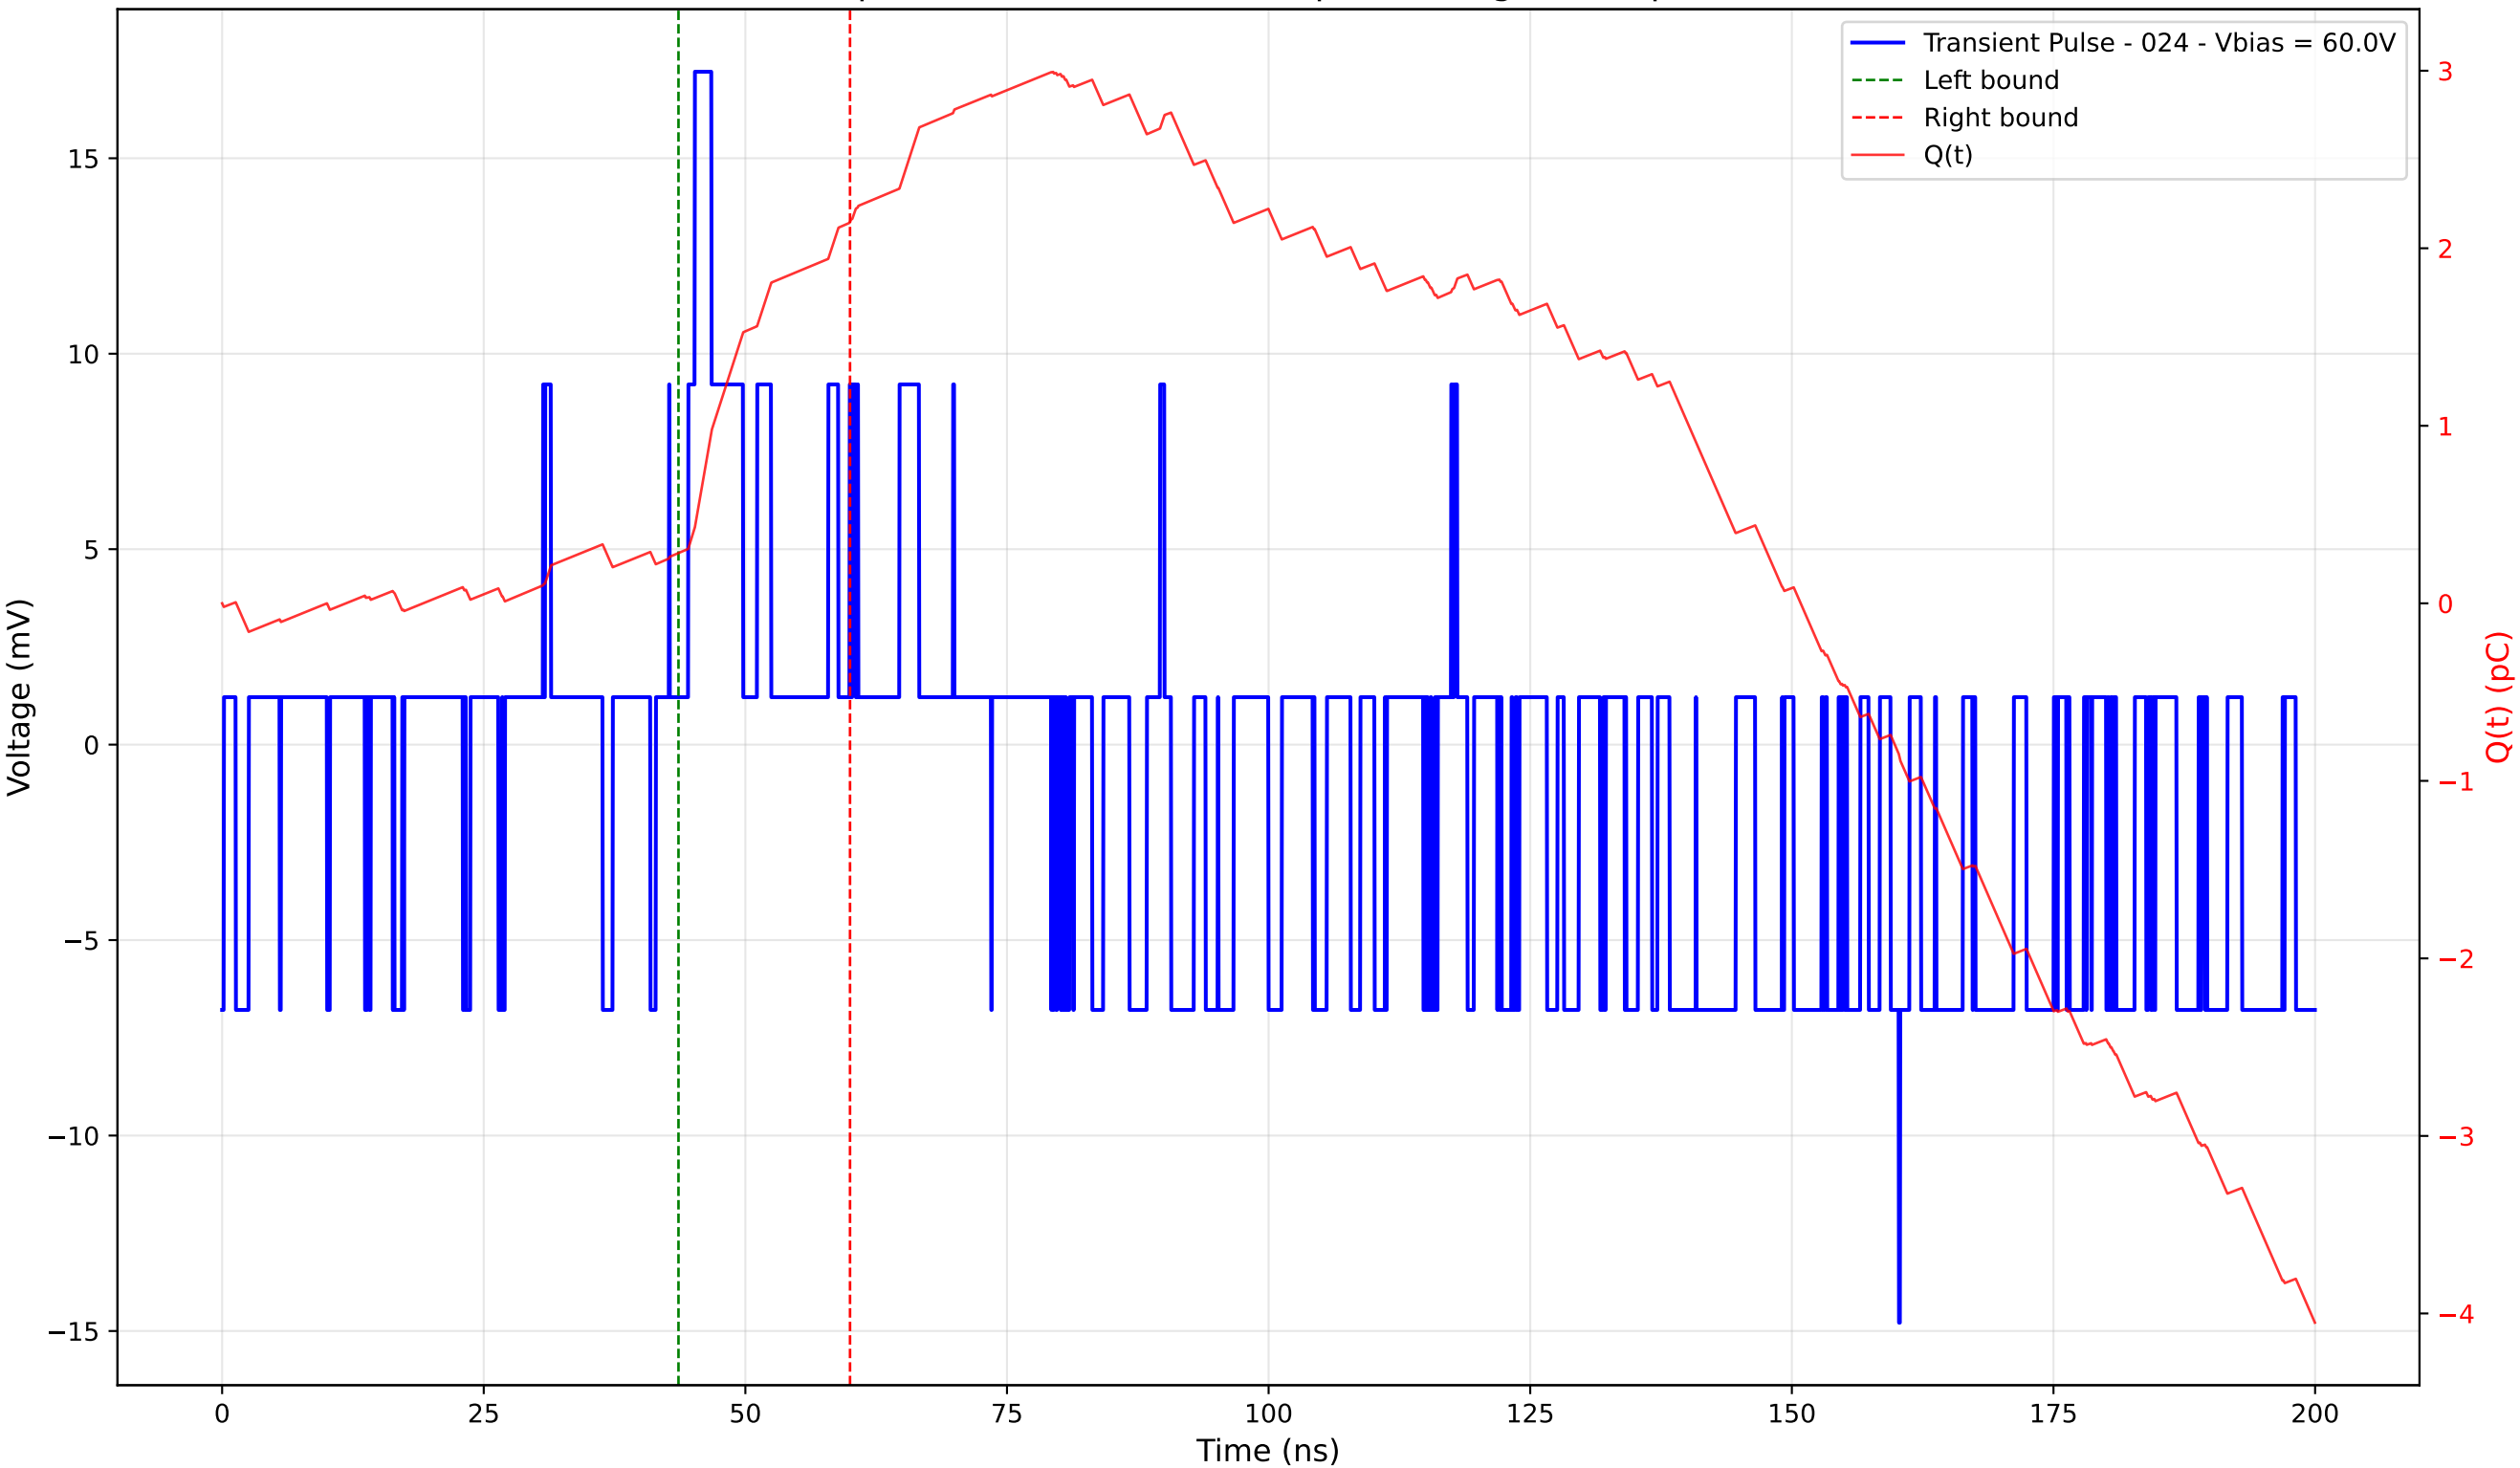


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.12 pC - Rise Time: 0.60 ns

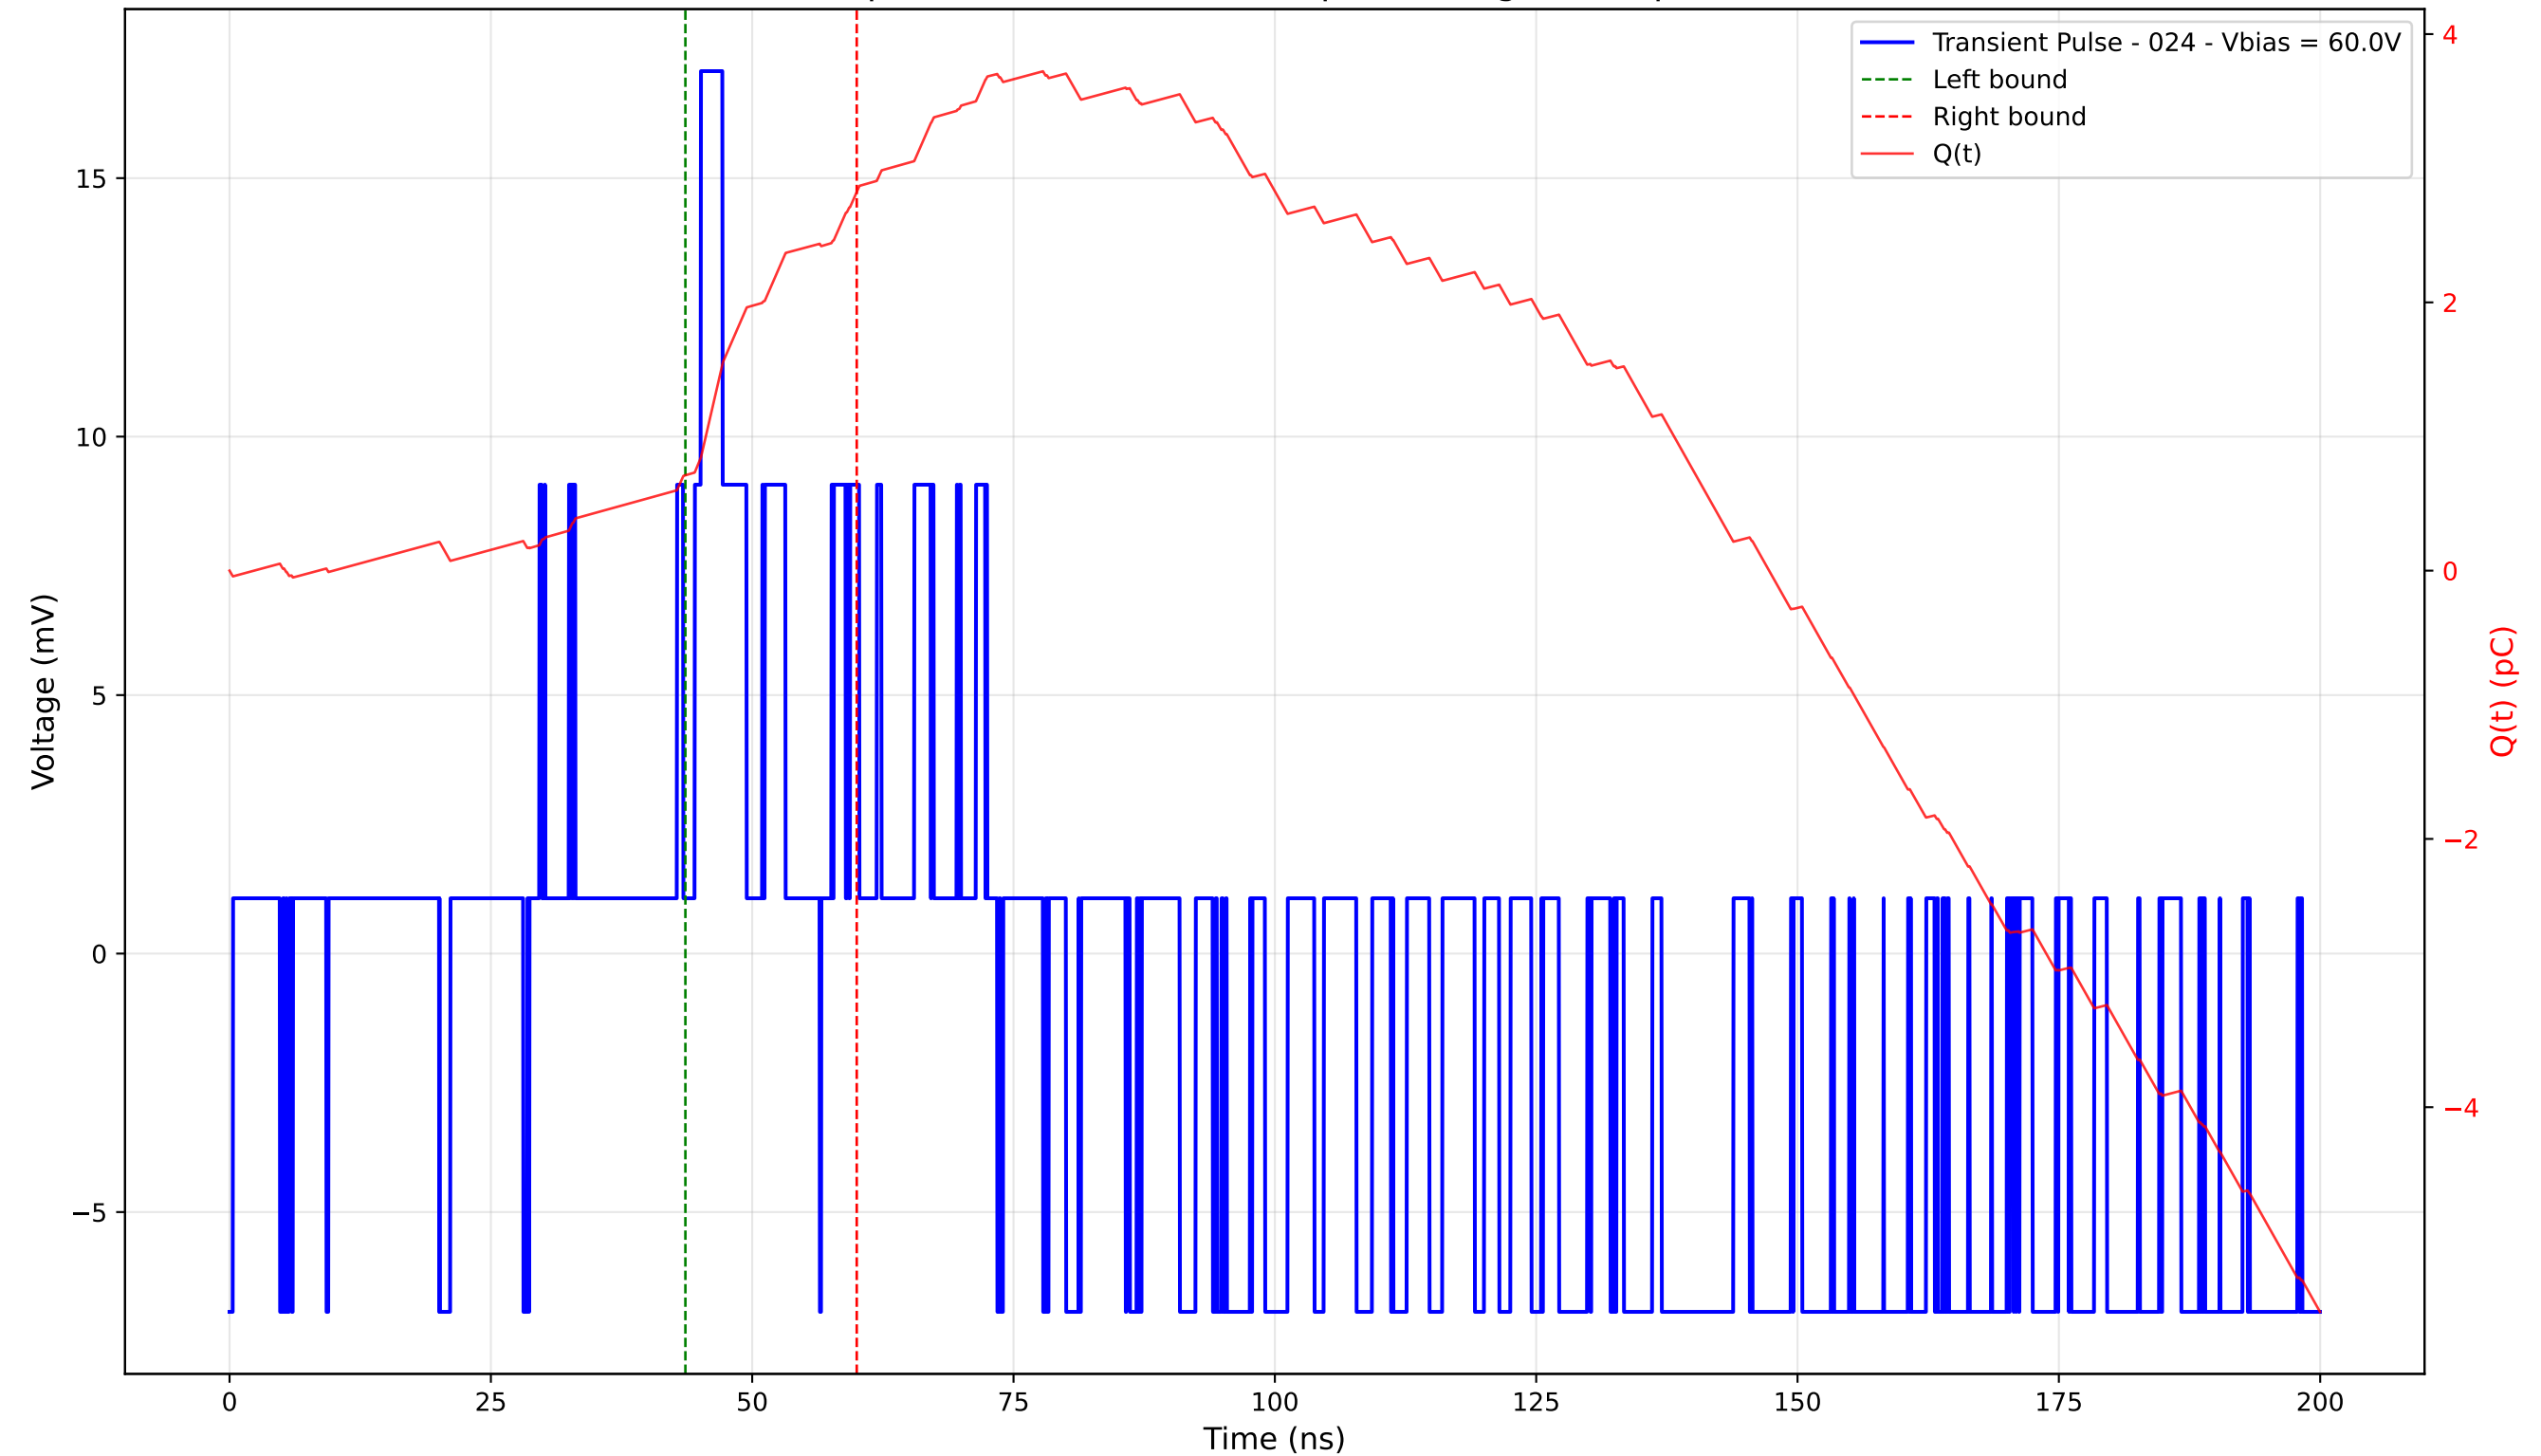


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.60 pC - Rise Time: 1.34 ns

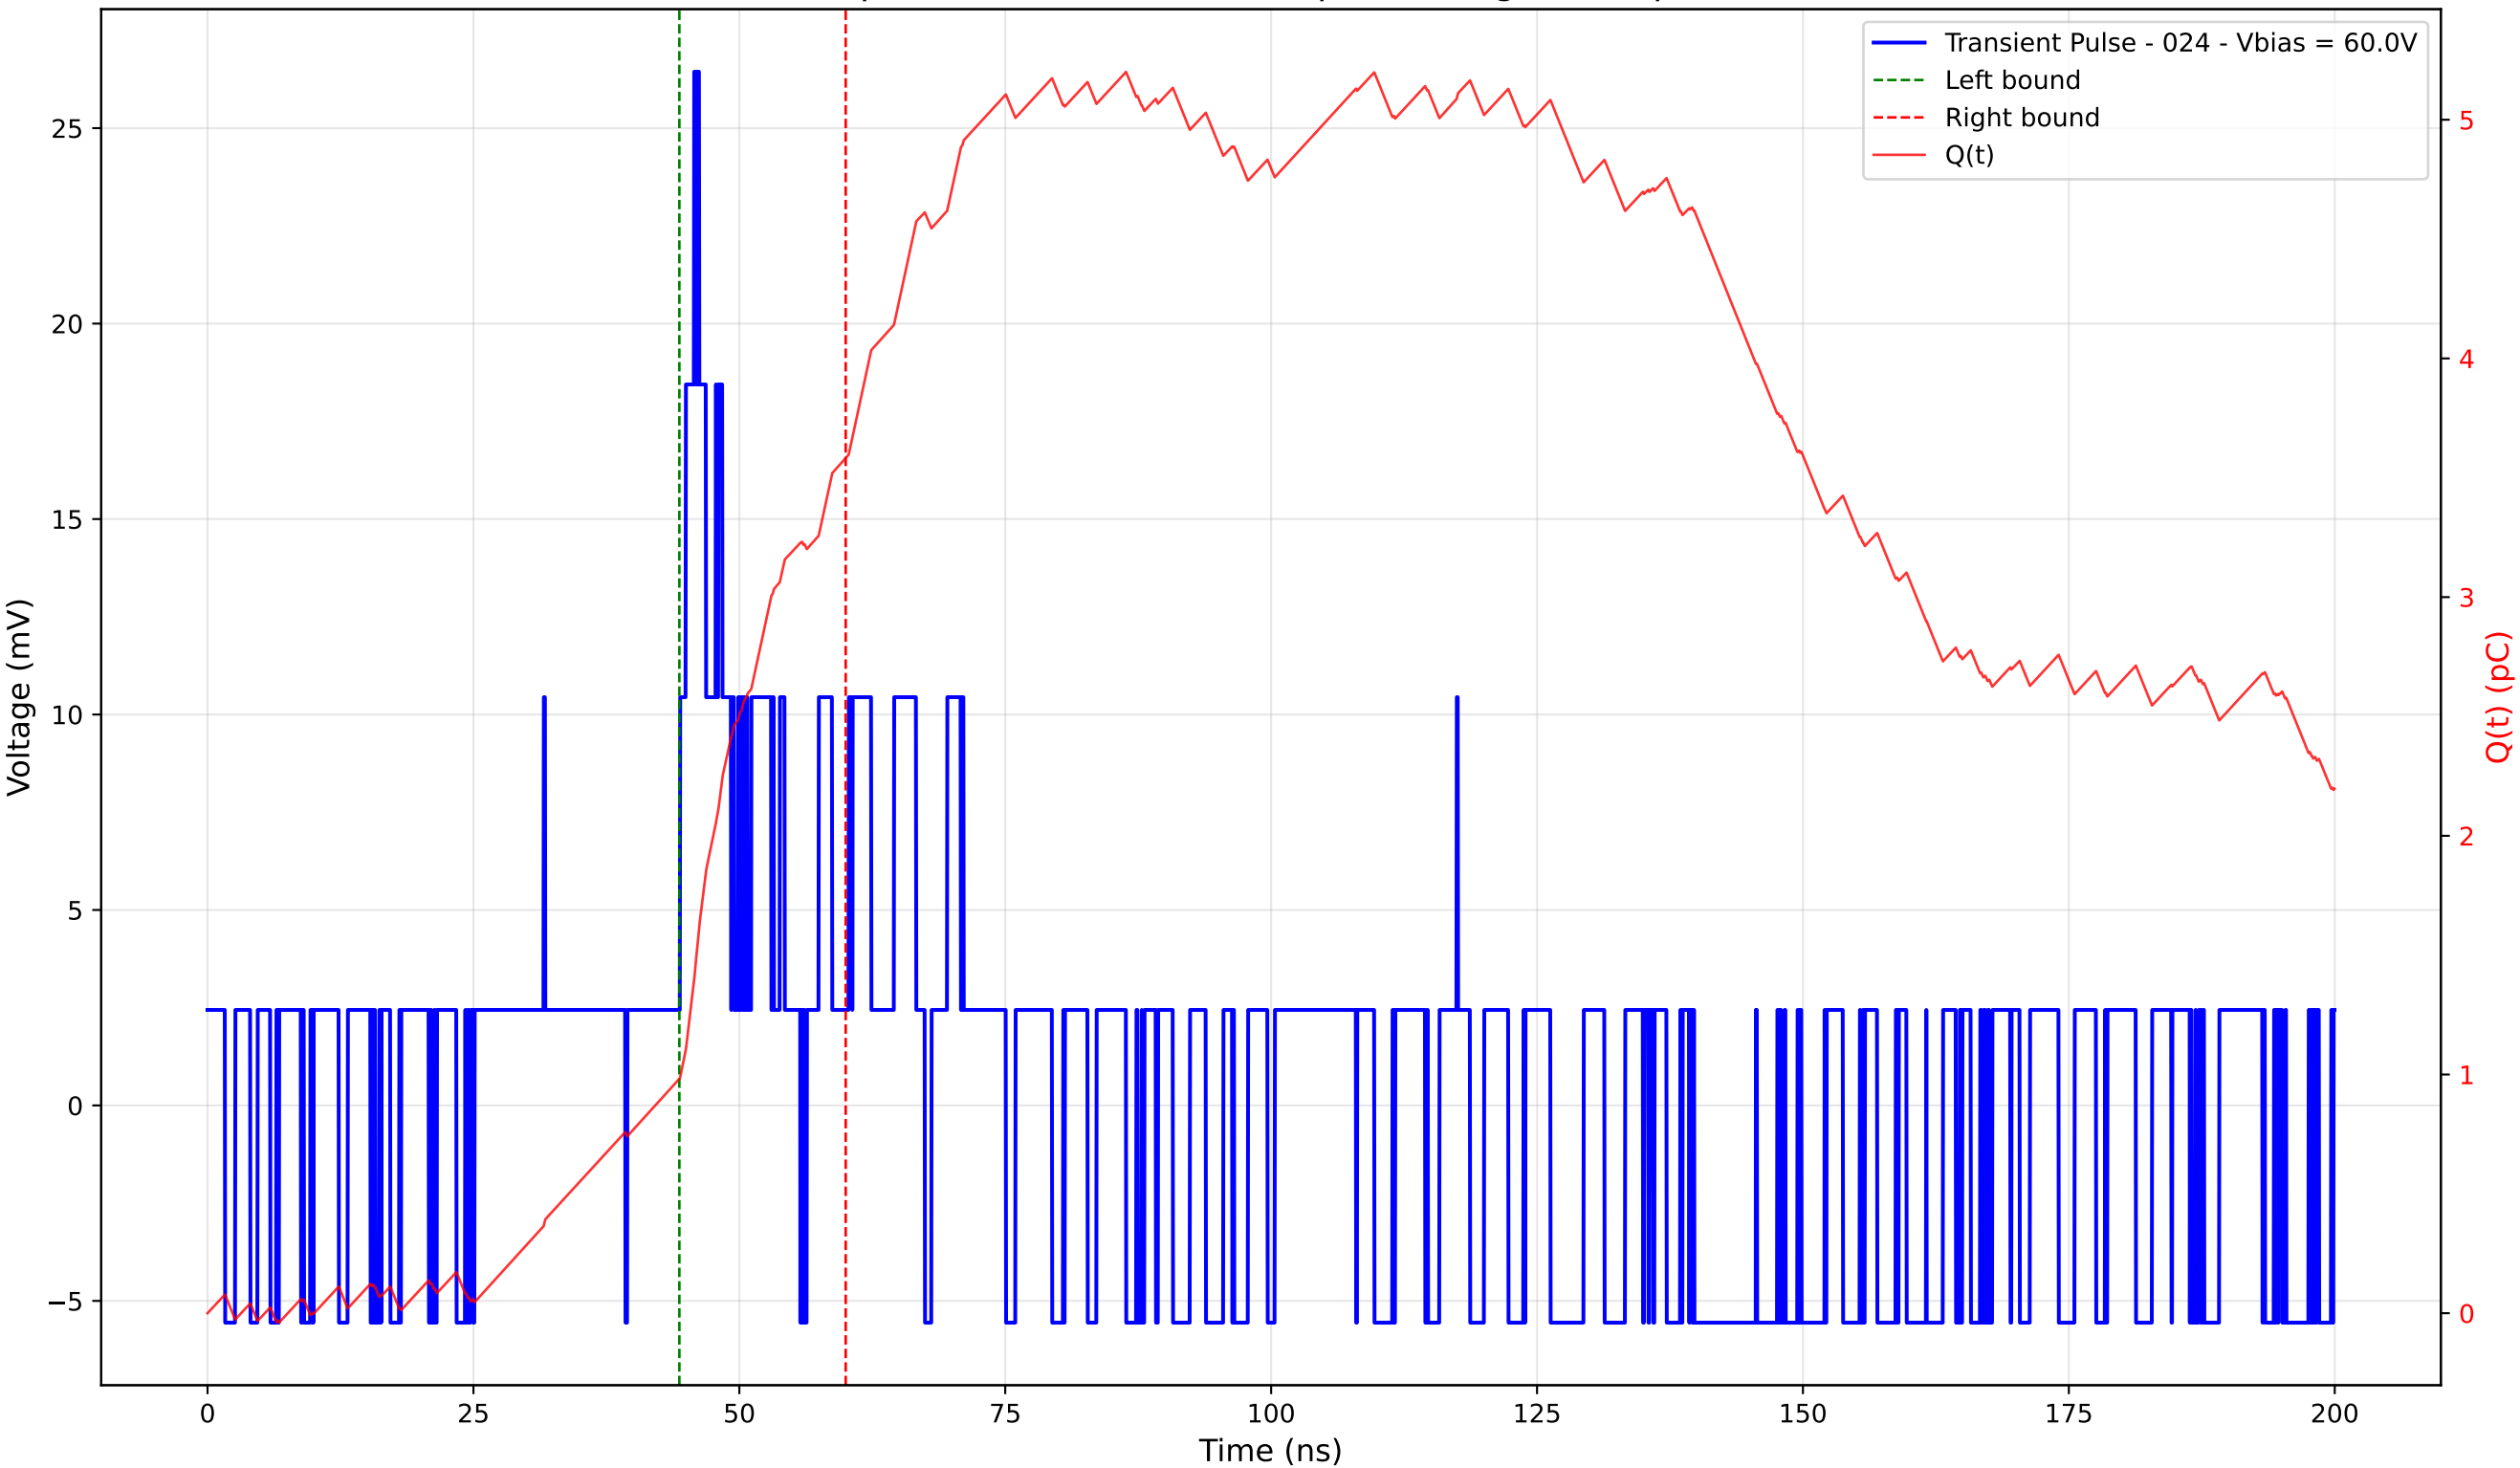


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.14 pC - Rise Time: 0.96 ns

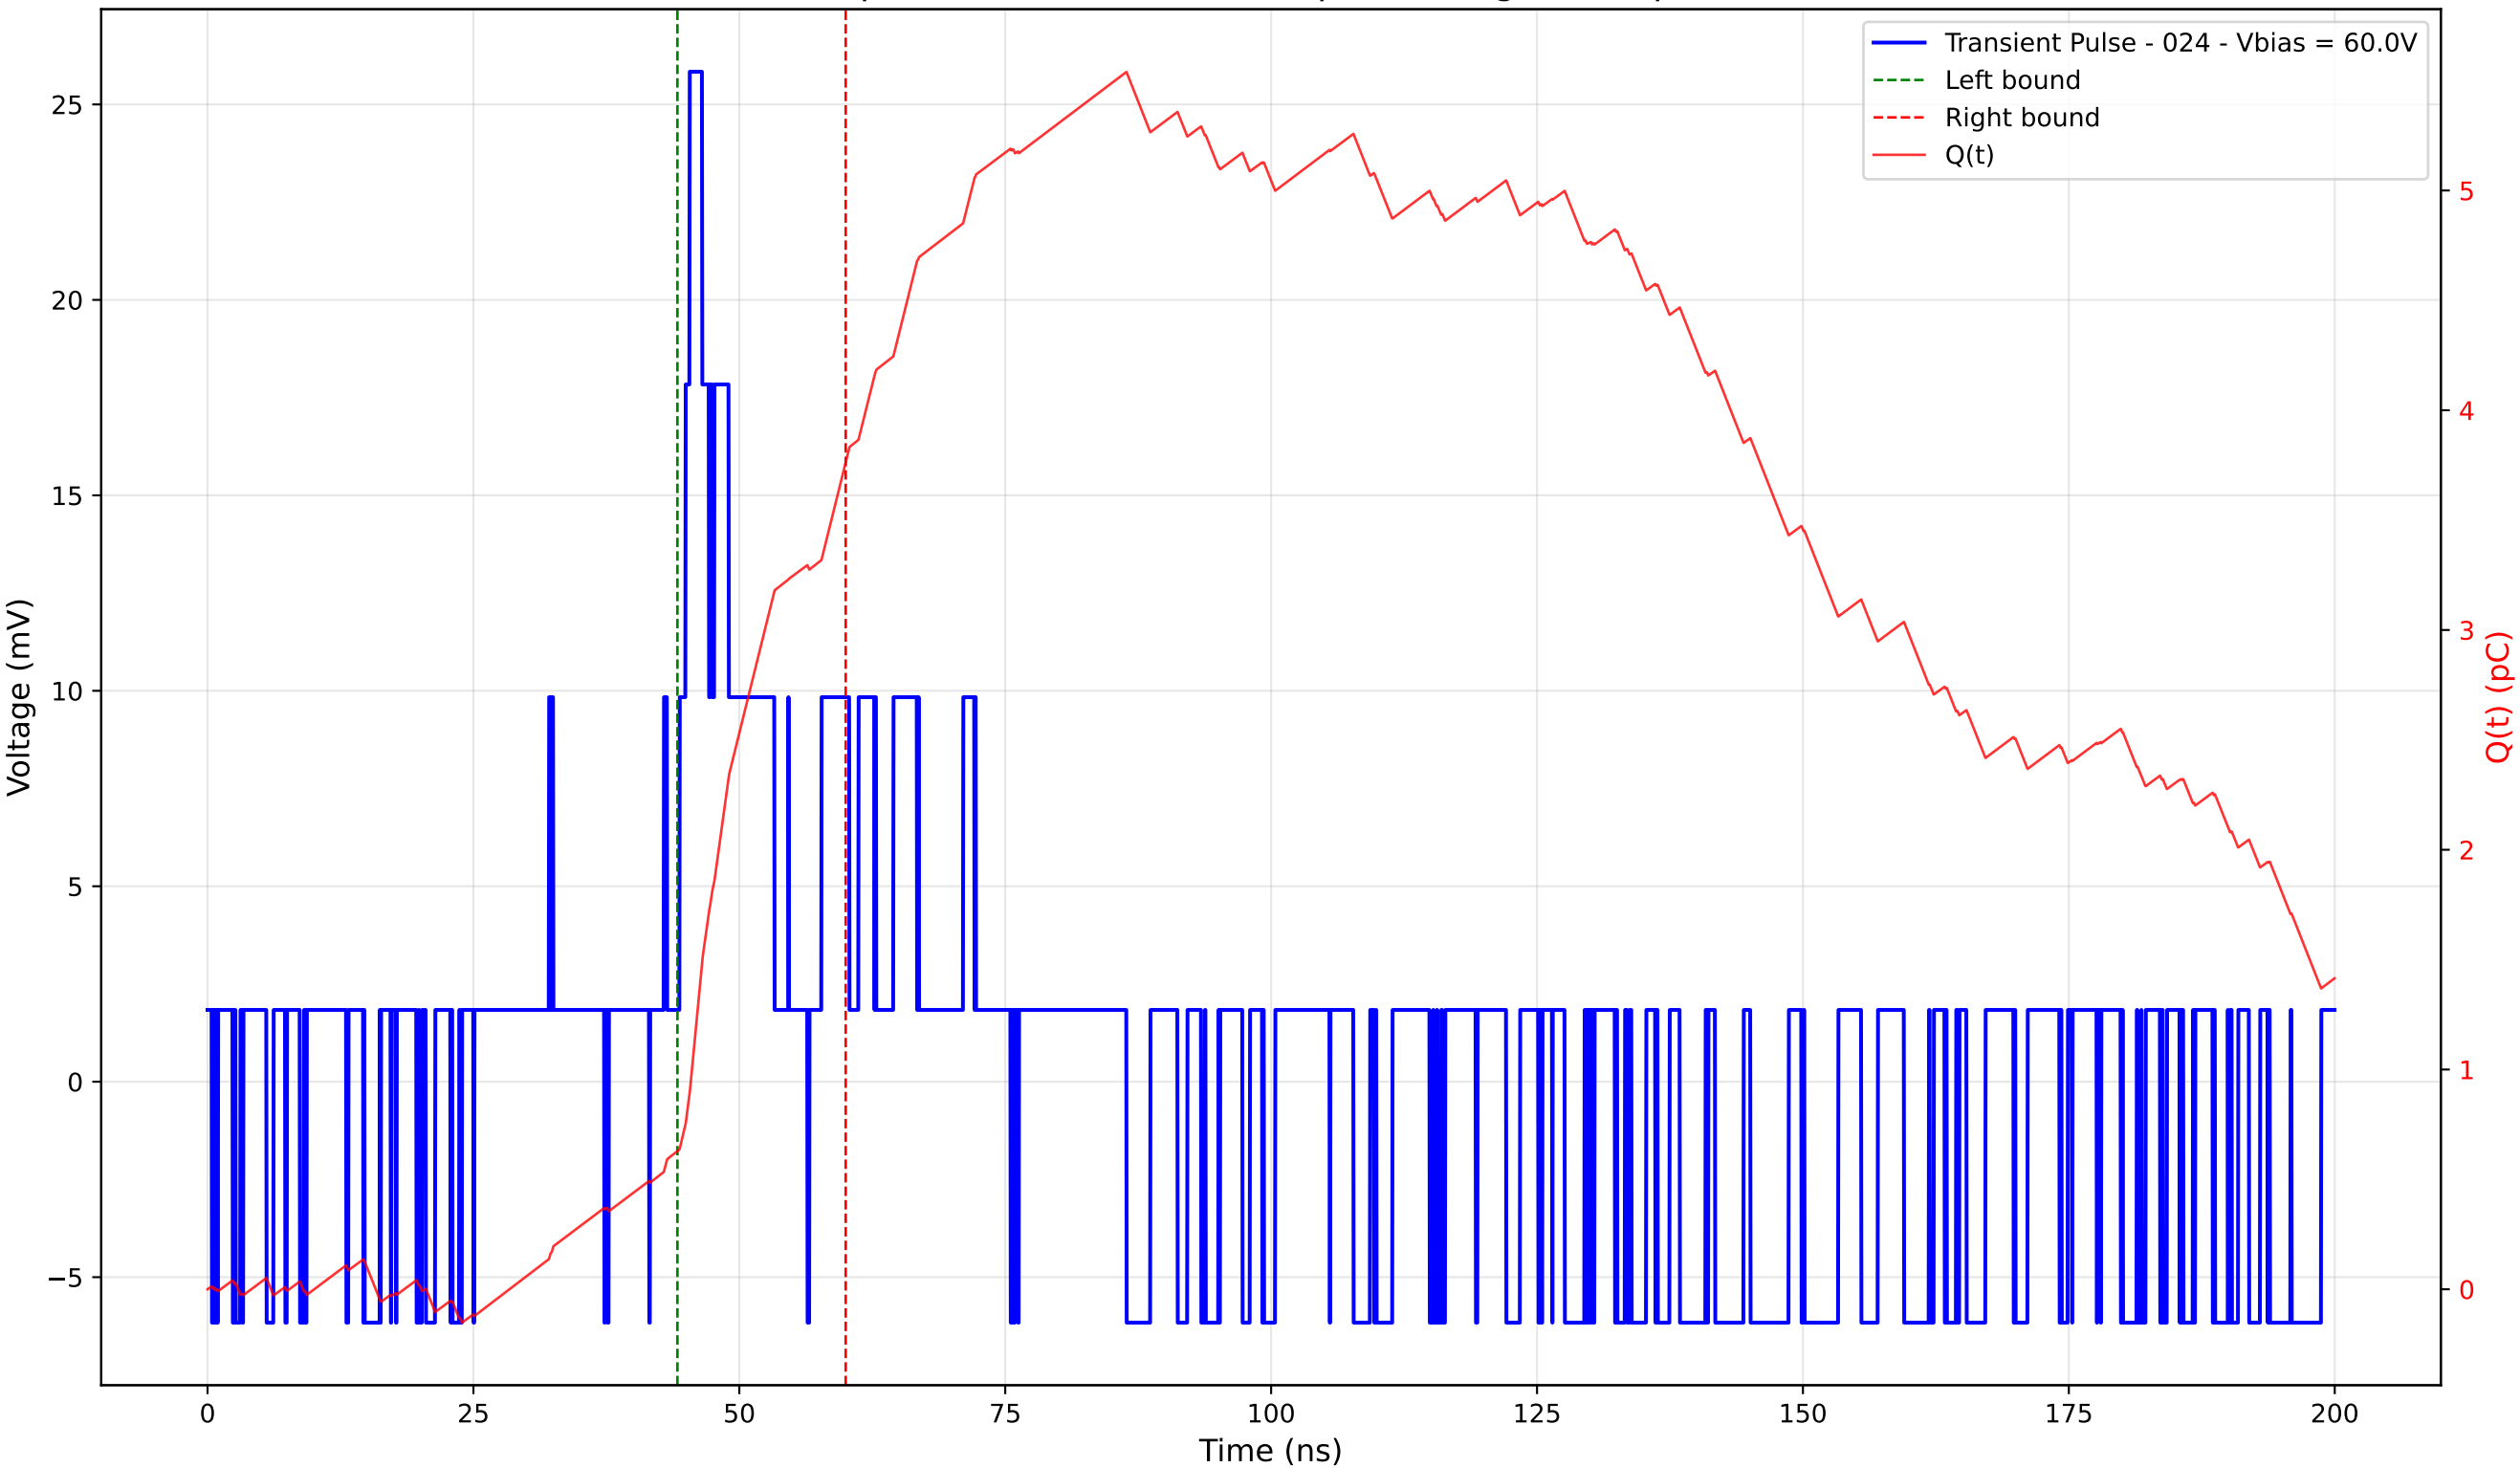


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.24 pC - Rise Time: 0.74 ns

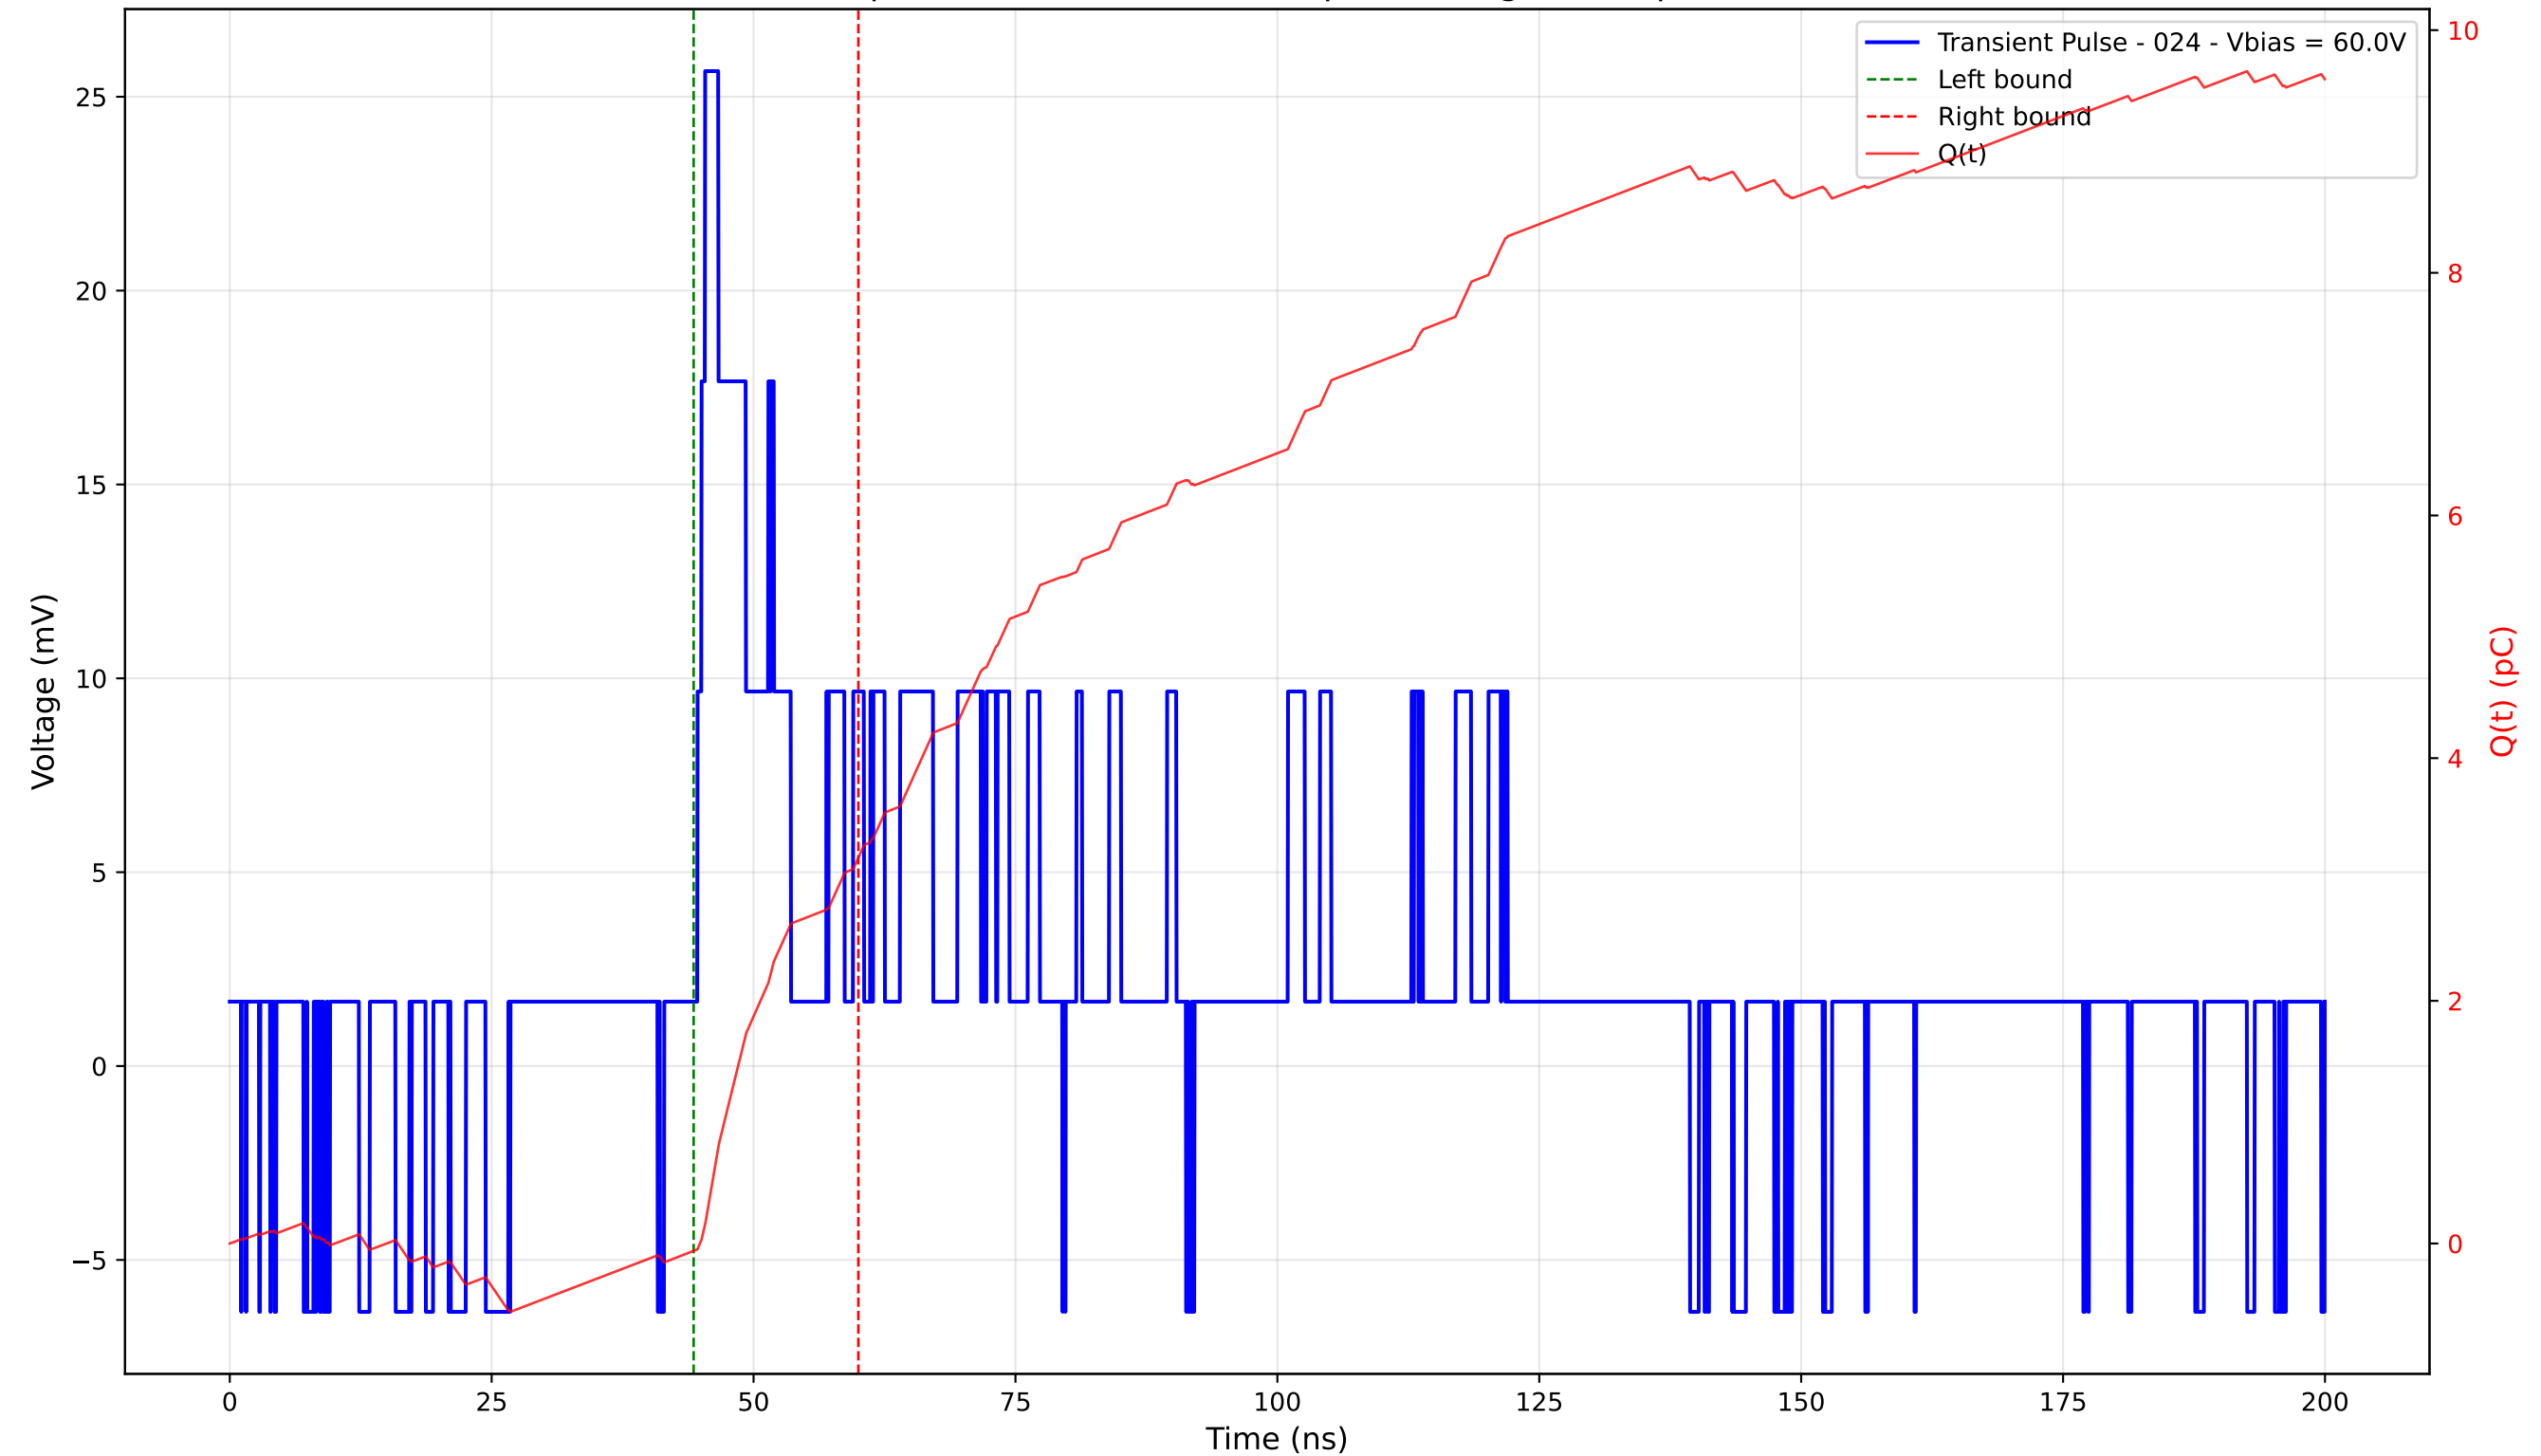


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 3.82 pC - Rise Time: 1.31 ns

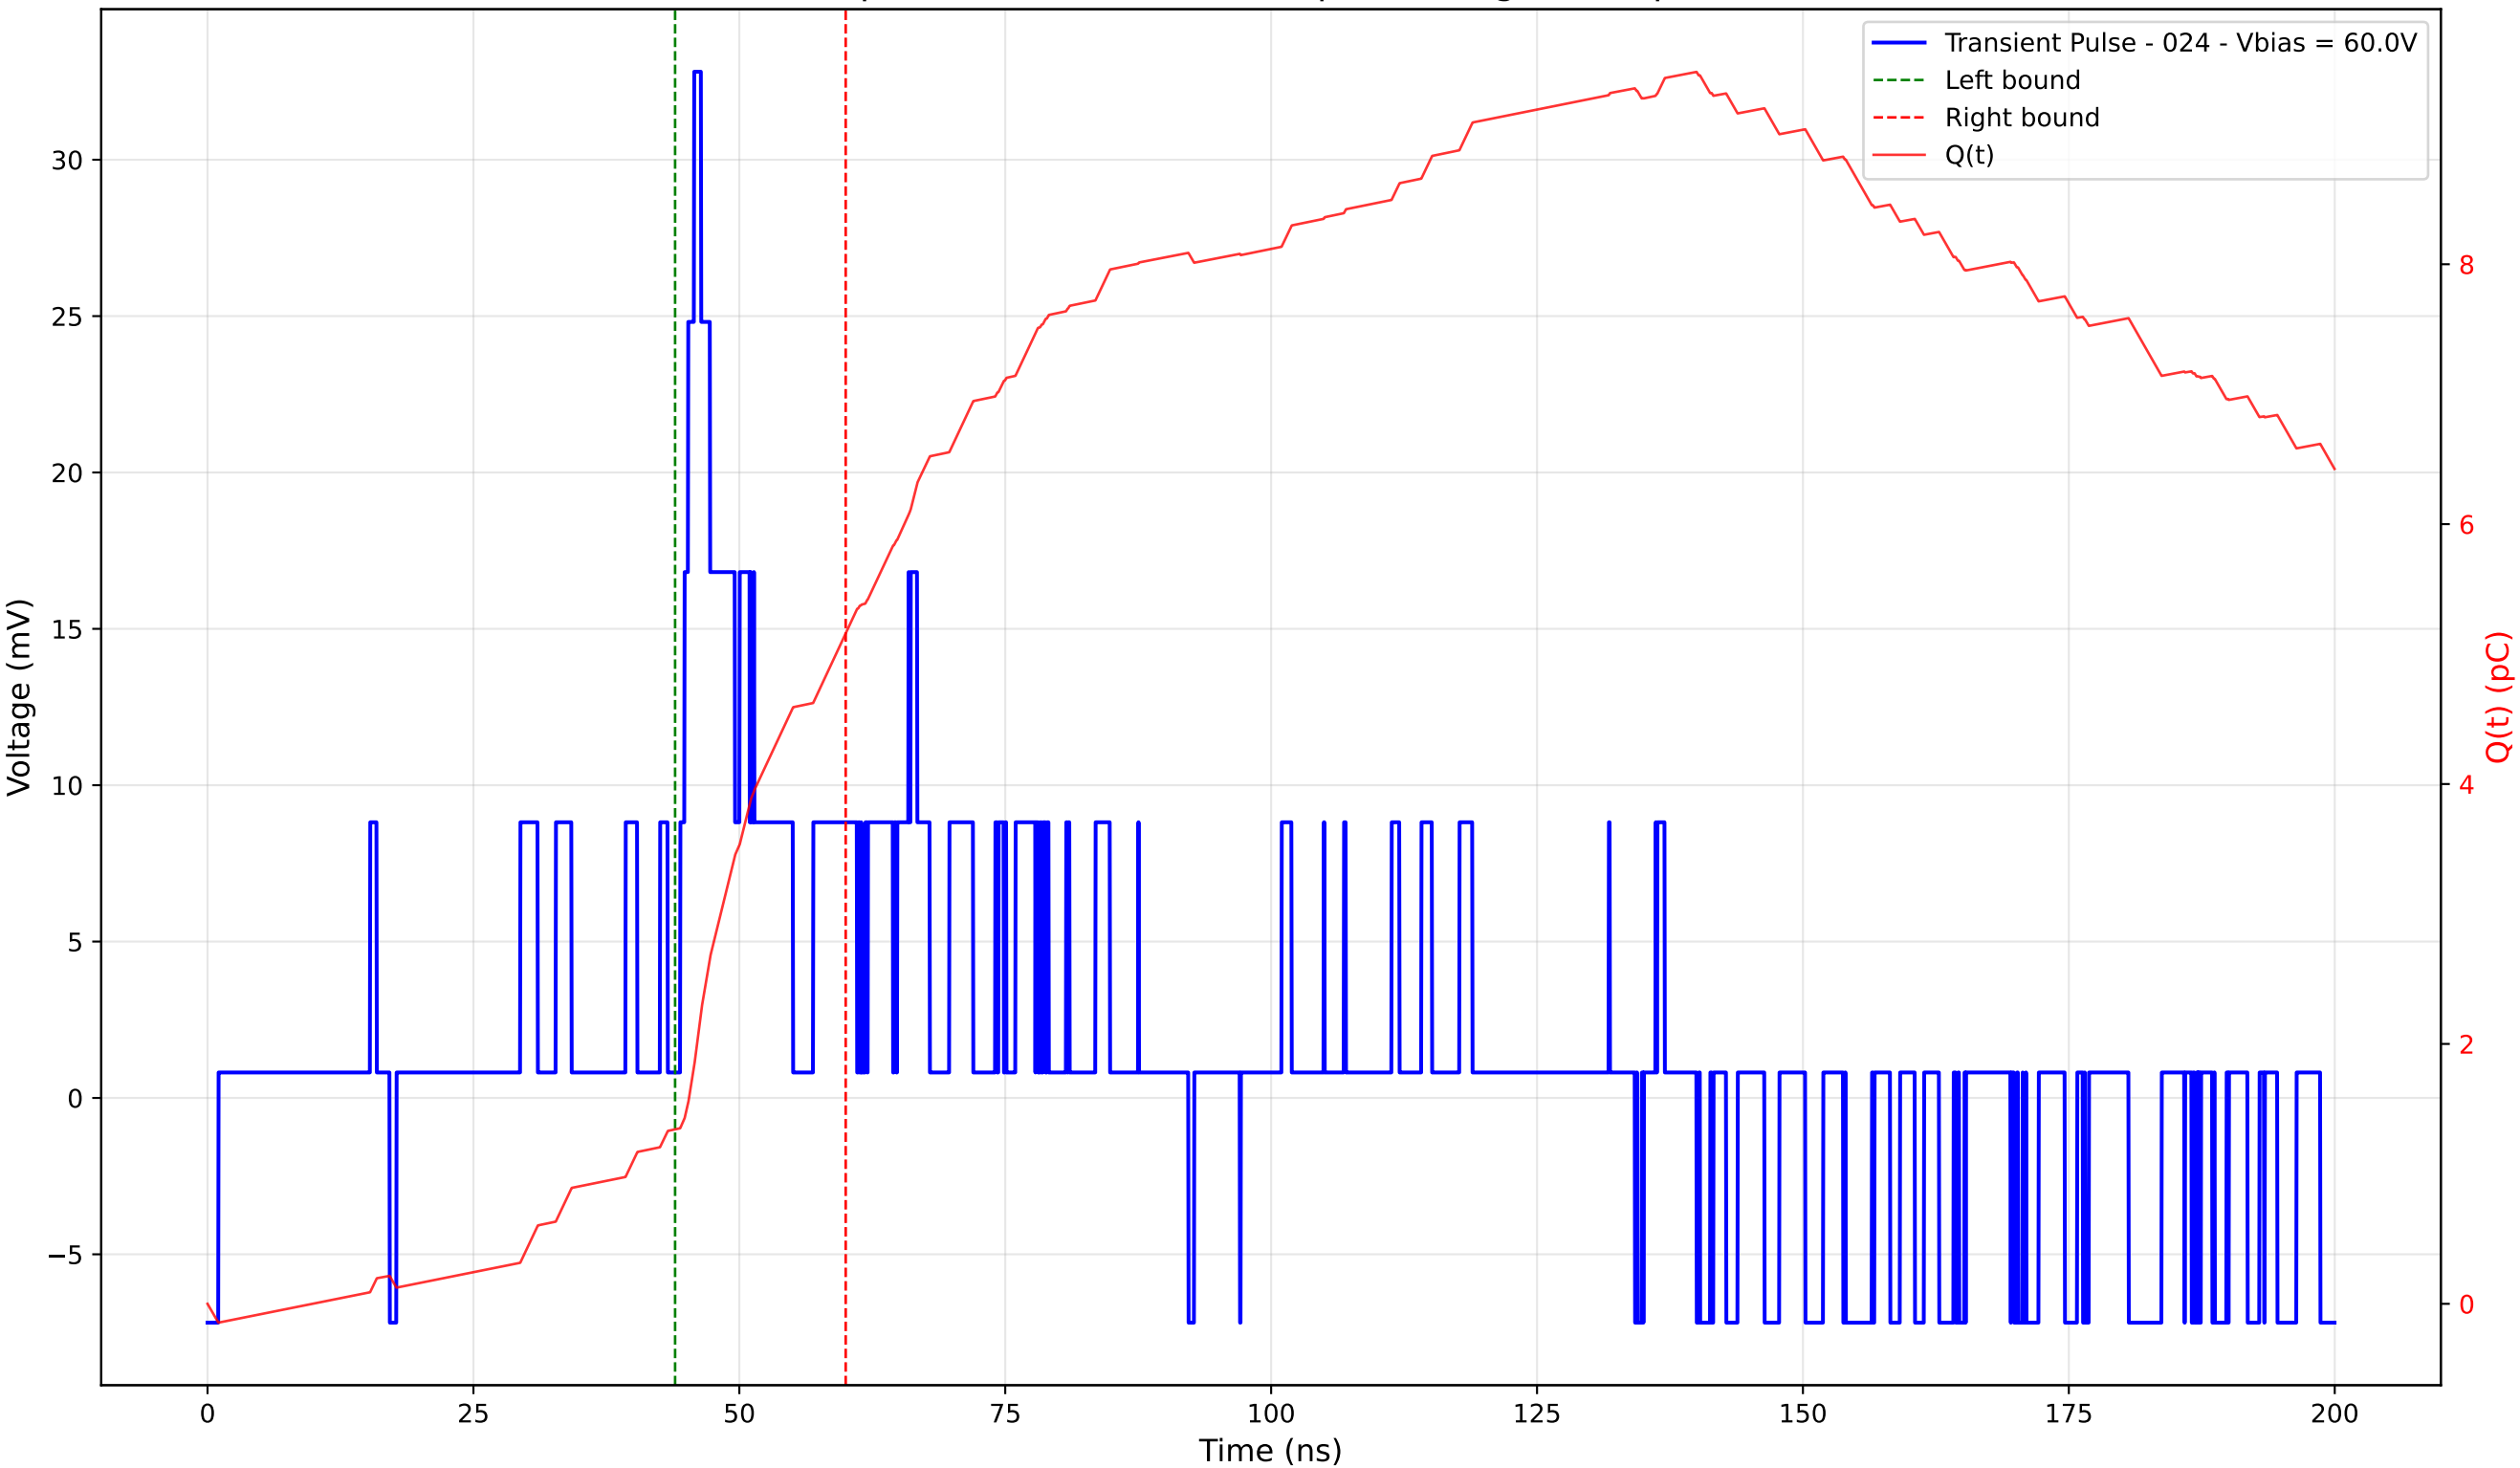


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 4.07 pC - Rise Time: 0.00 ns (N/A)

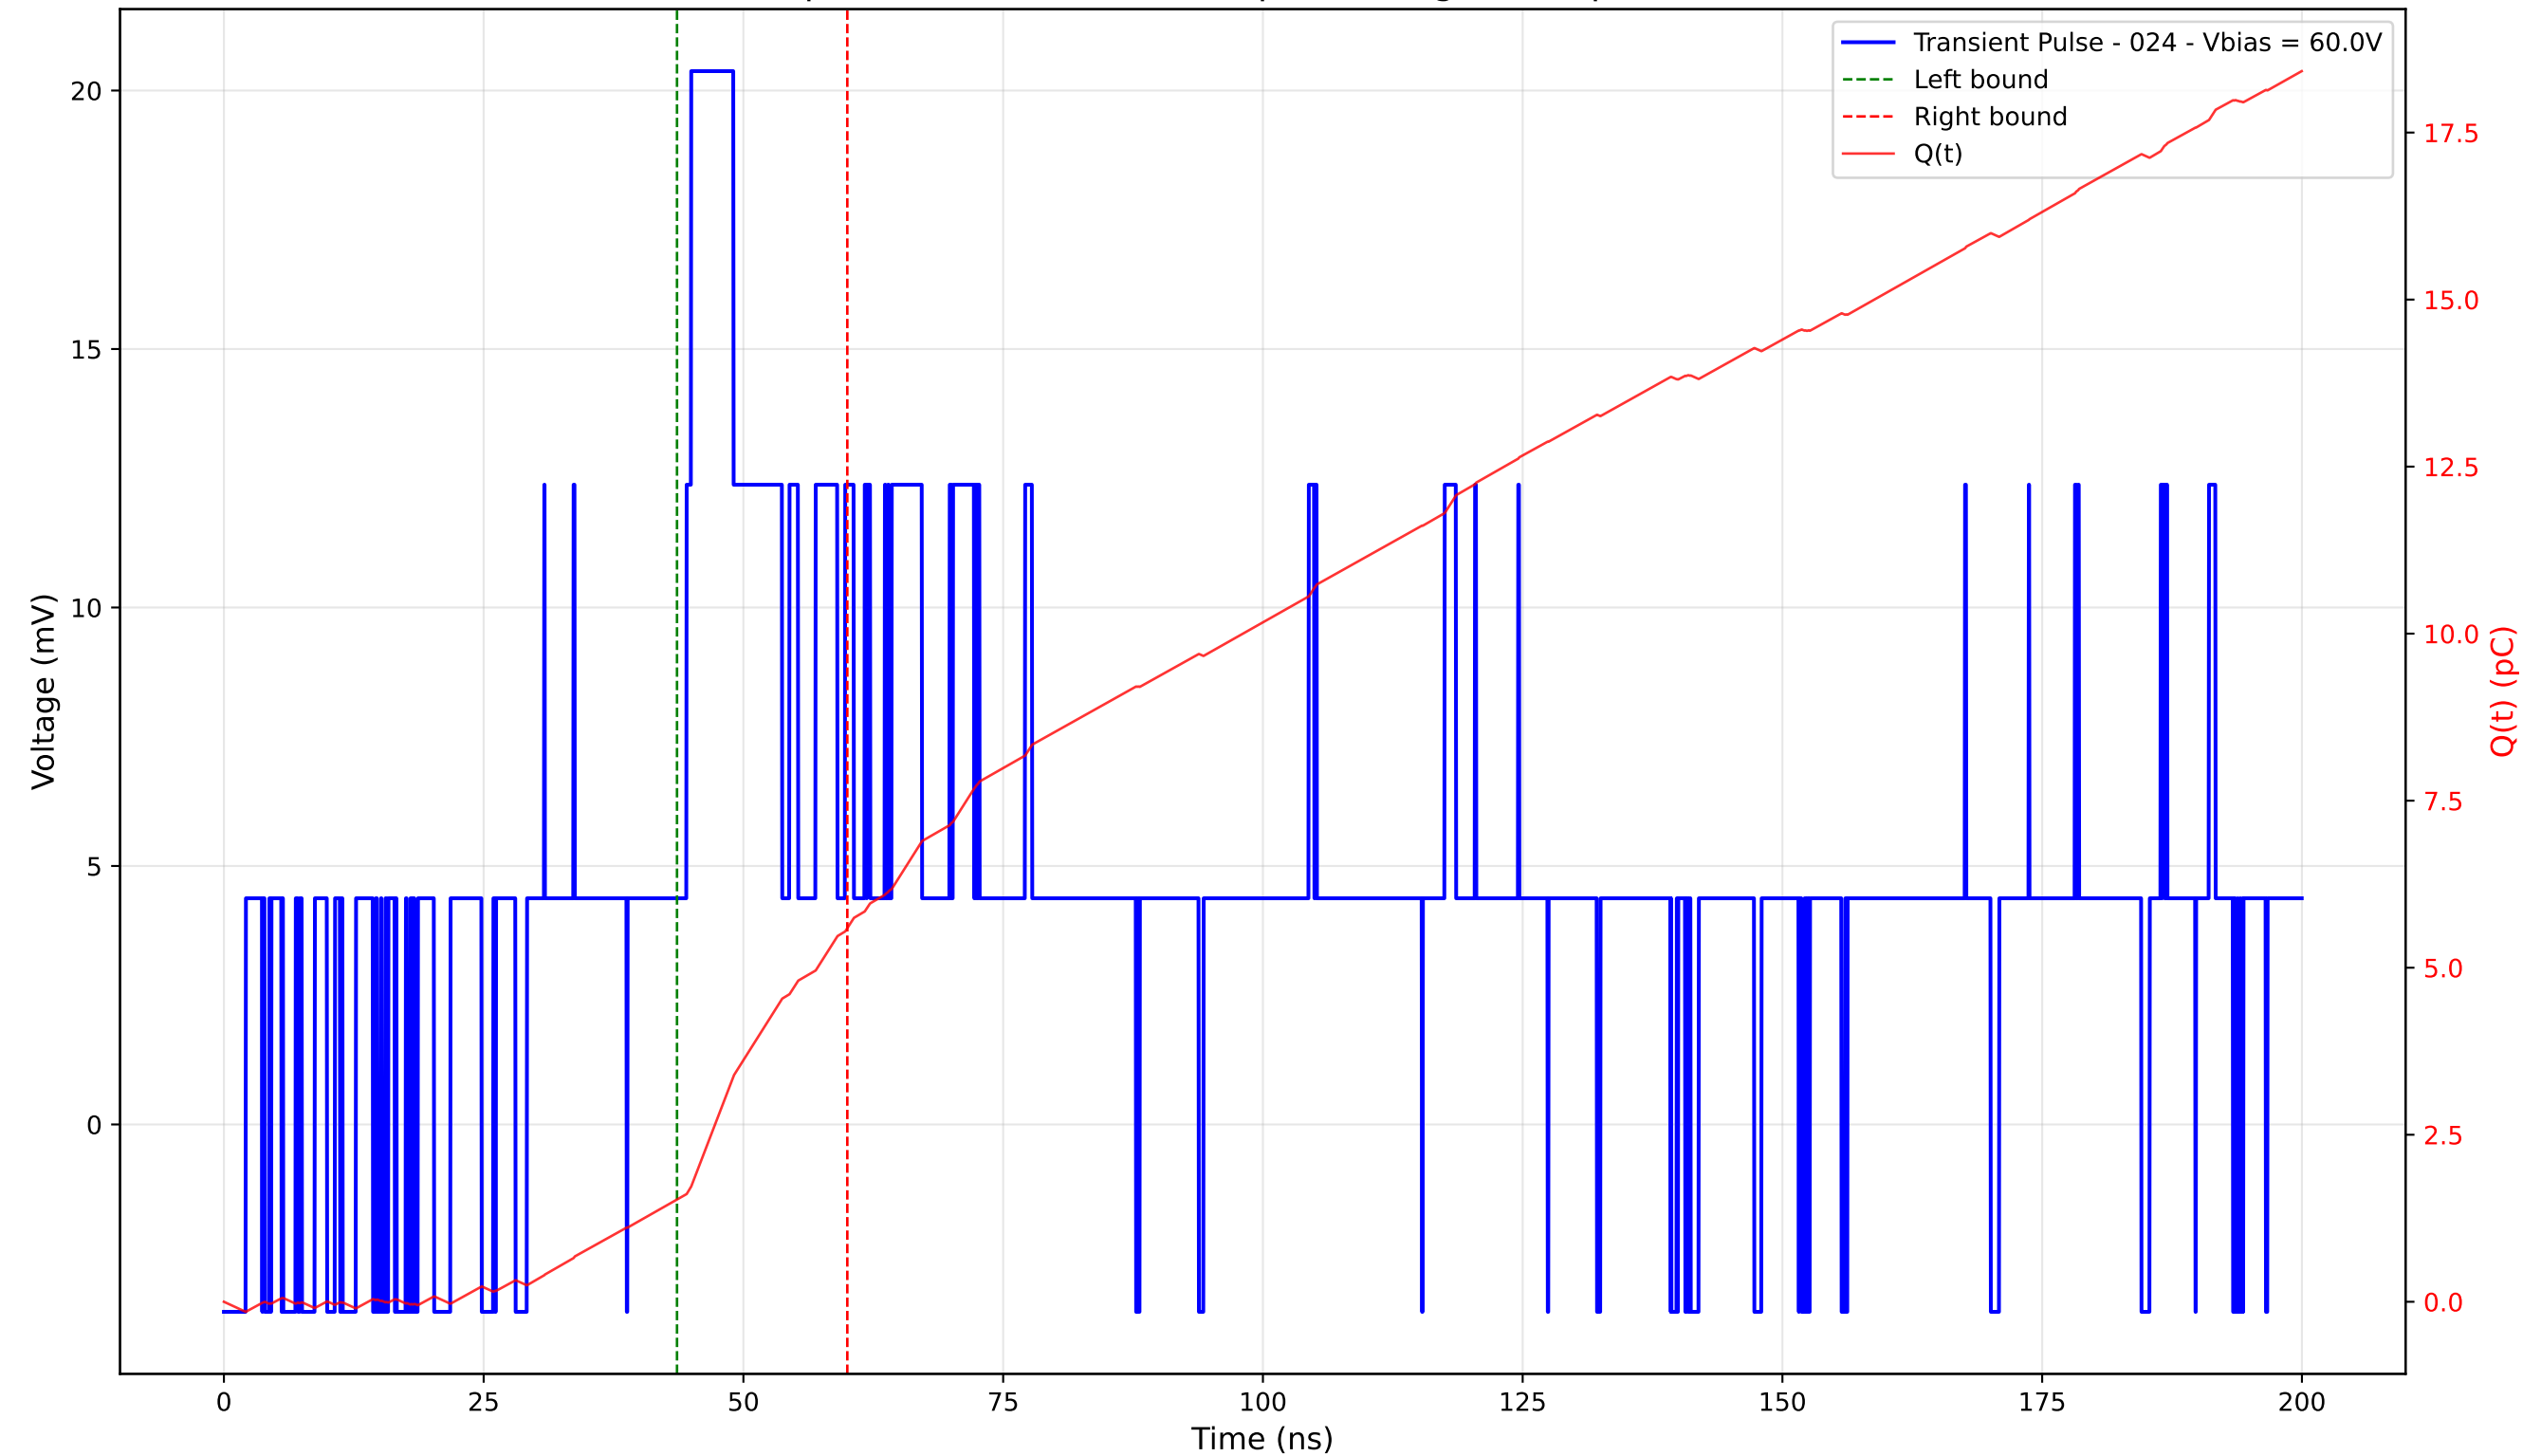


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 2.81 pC - Rise Time: 0.50 ns

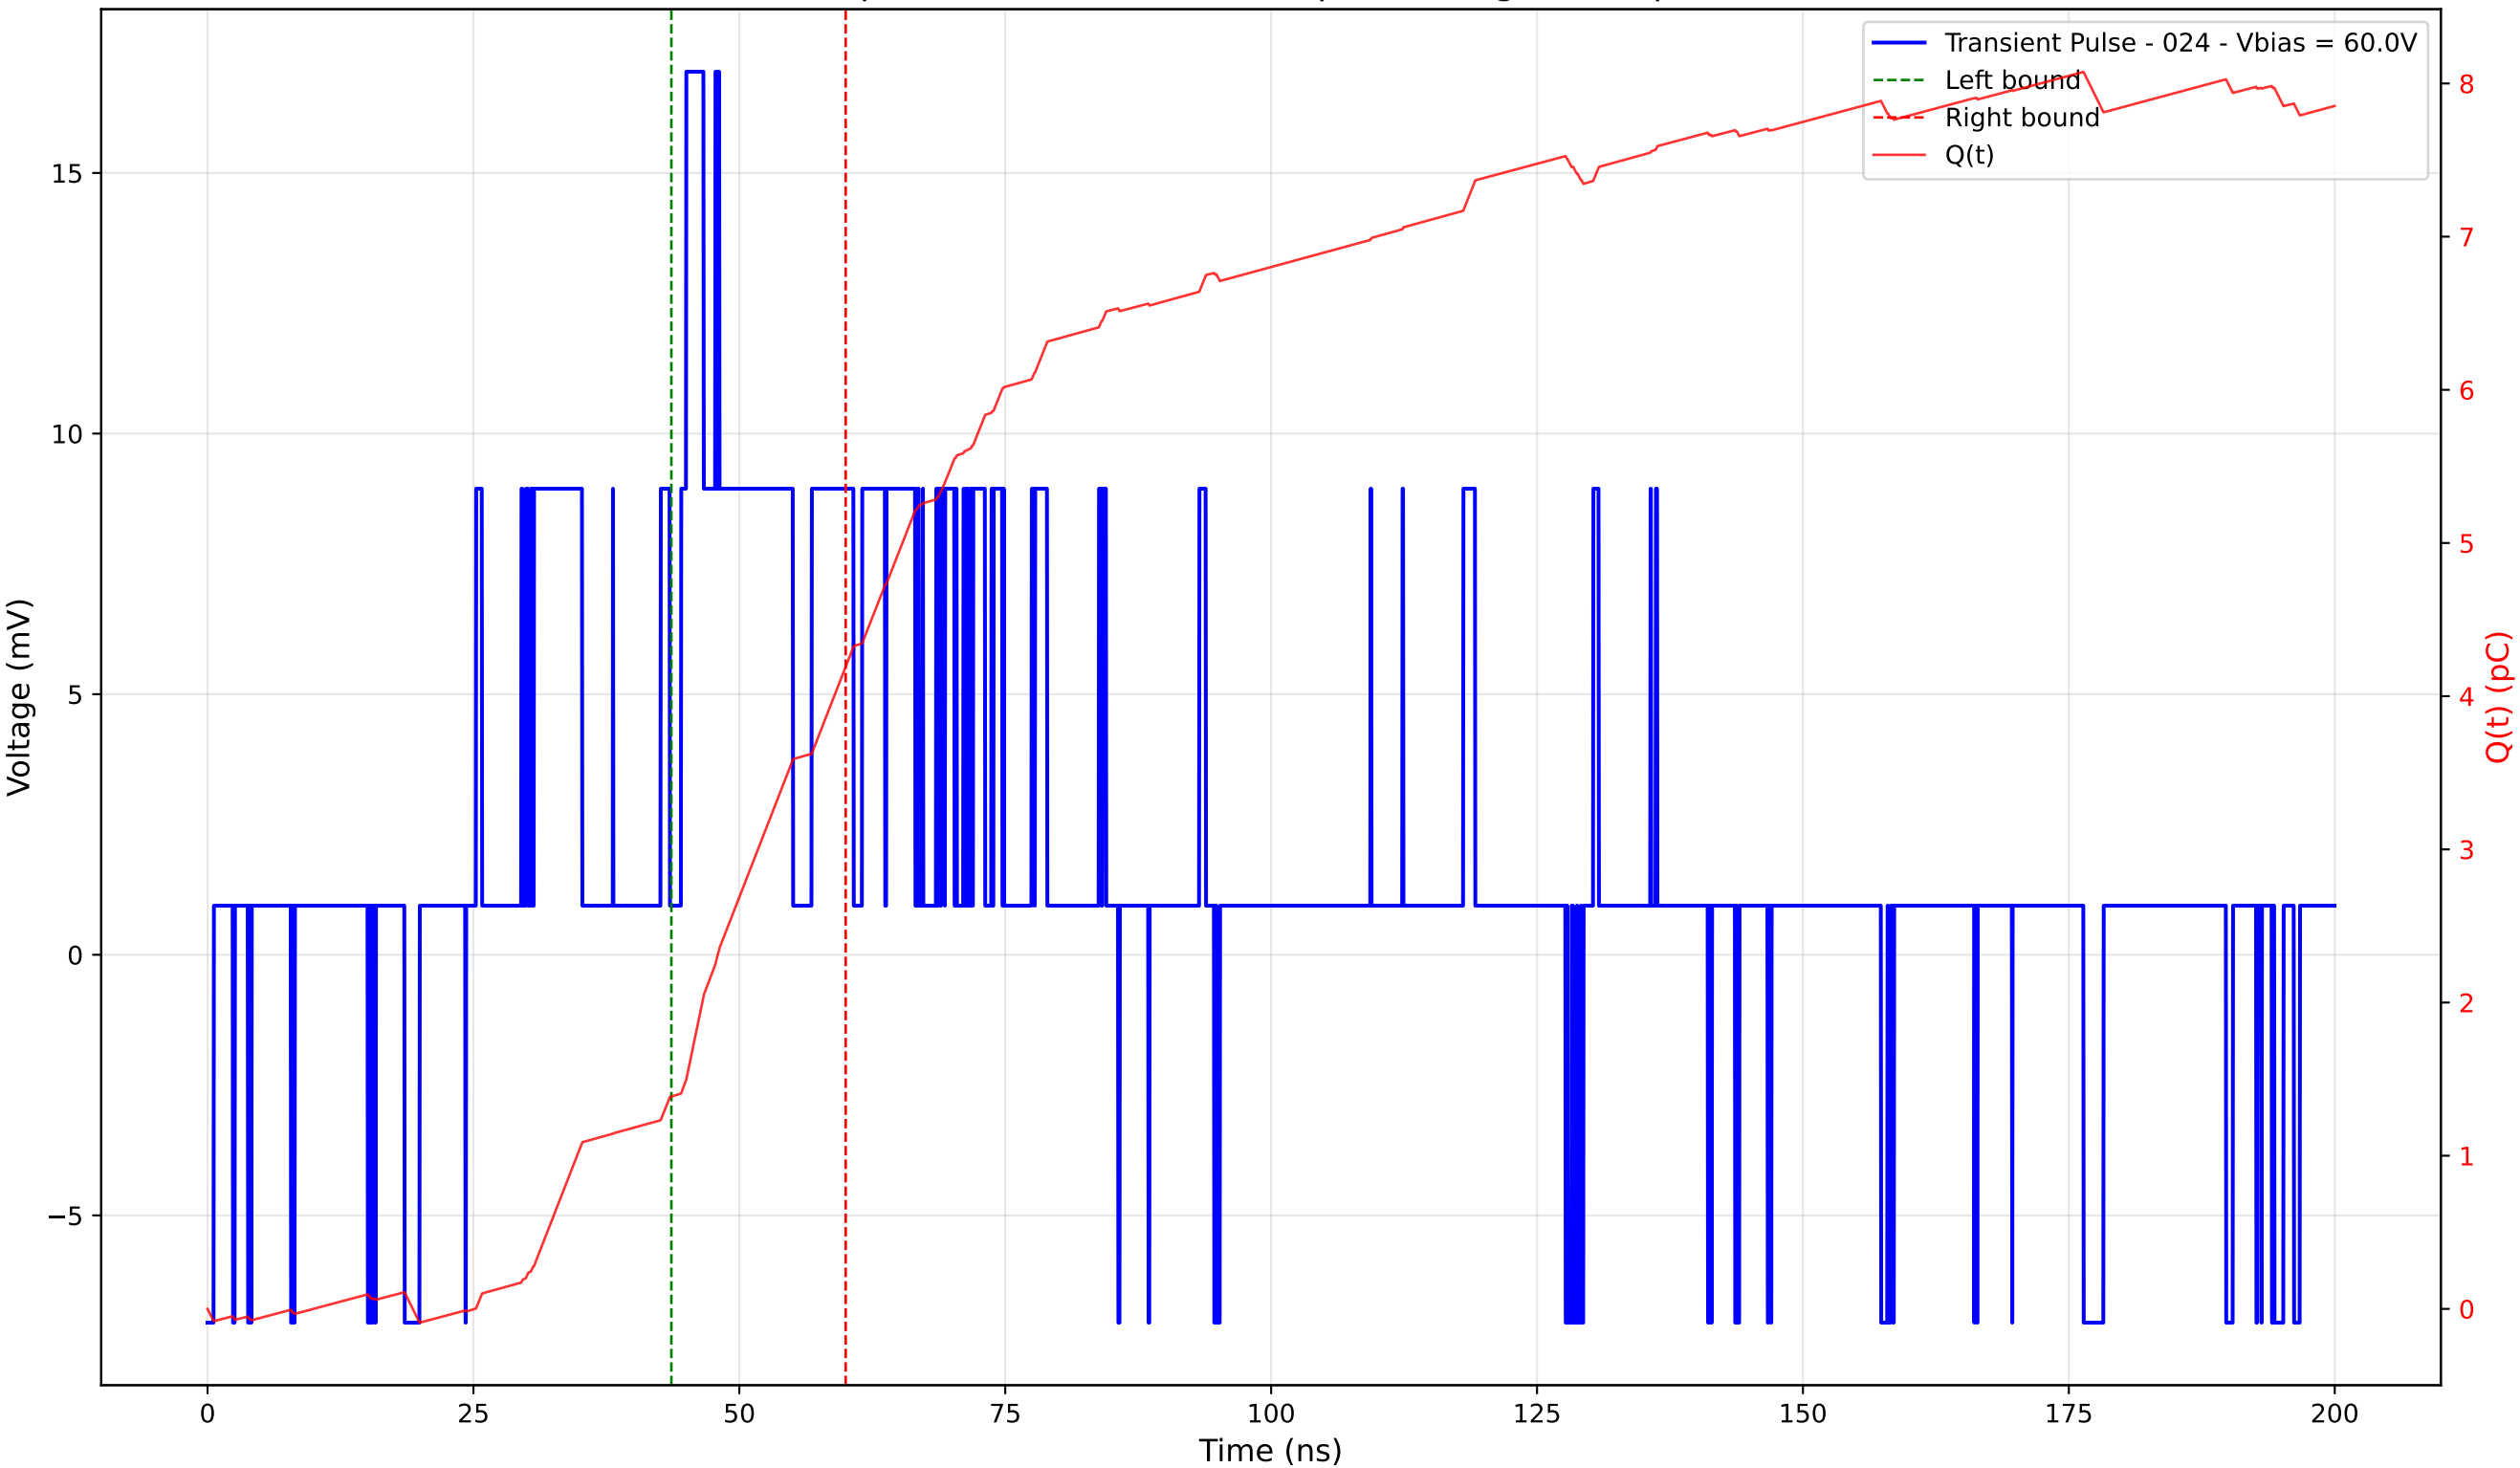


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 2.26 pC - Rise Time: 0.00 ns (N/A)

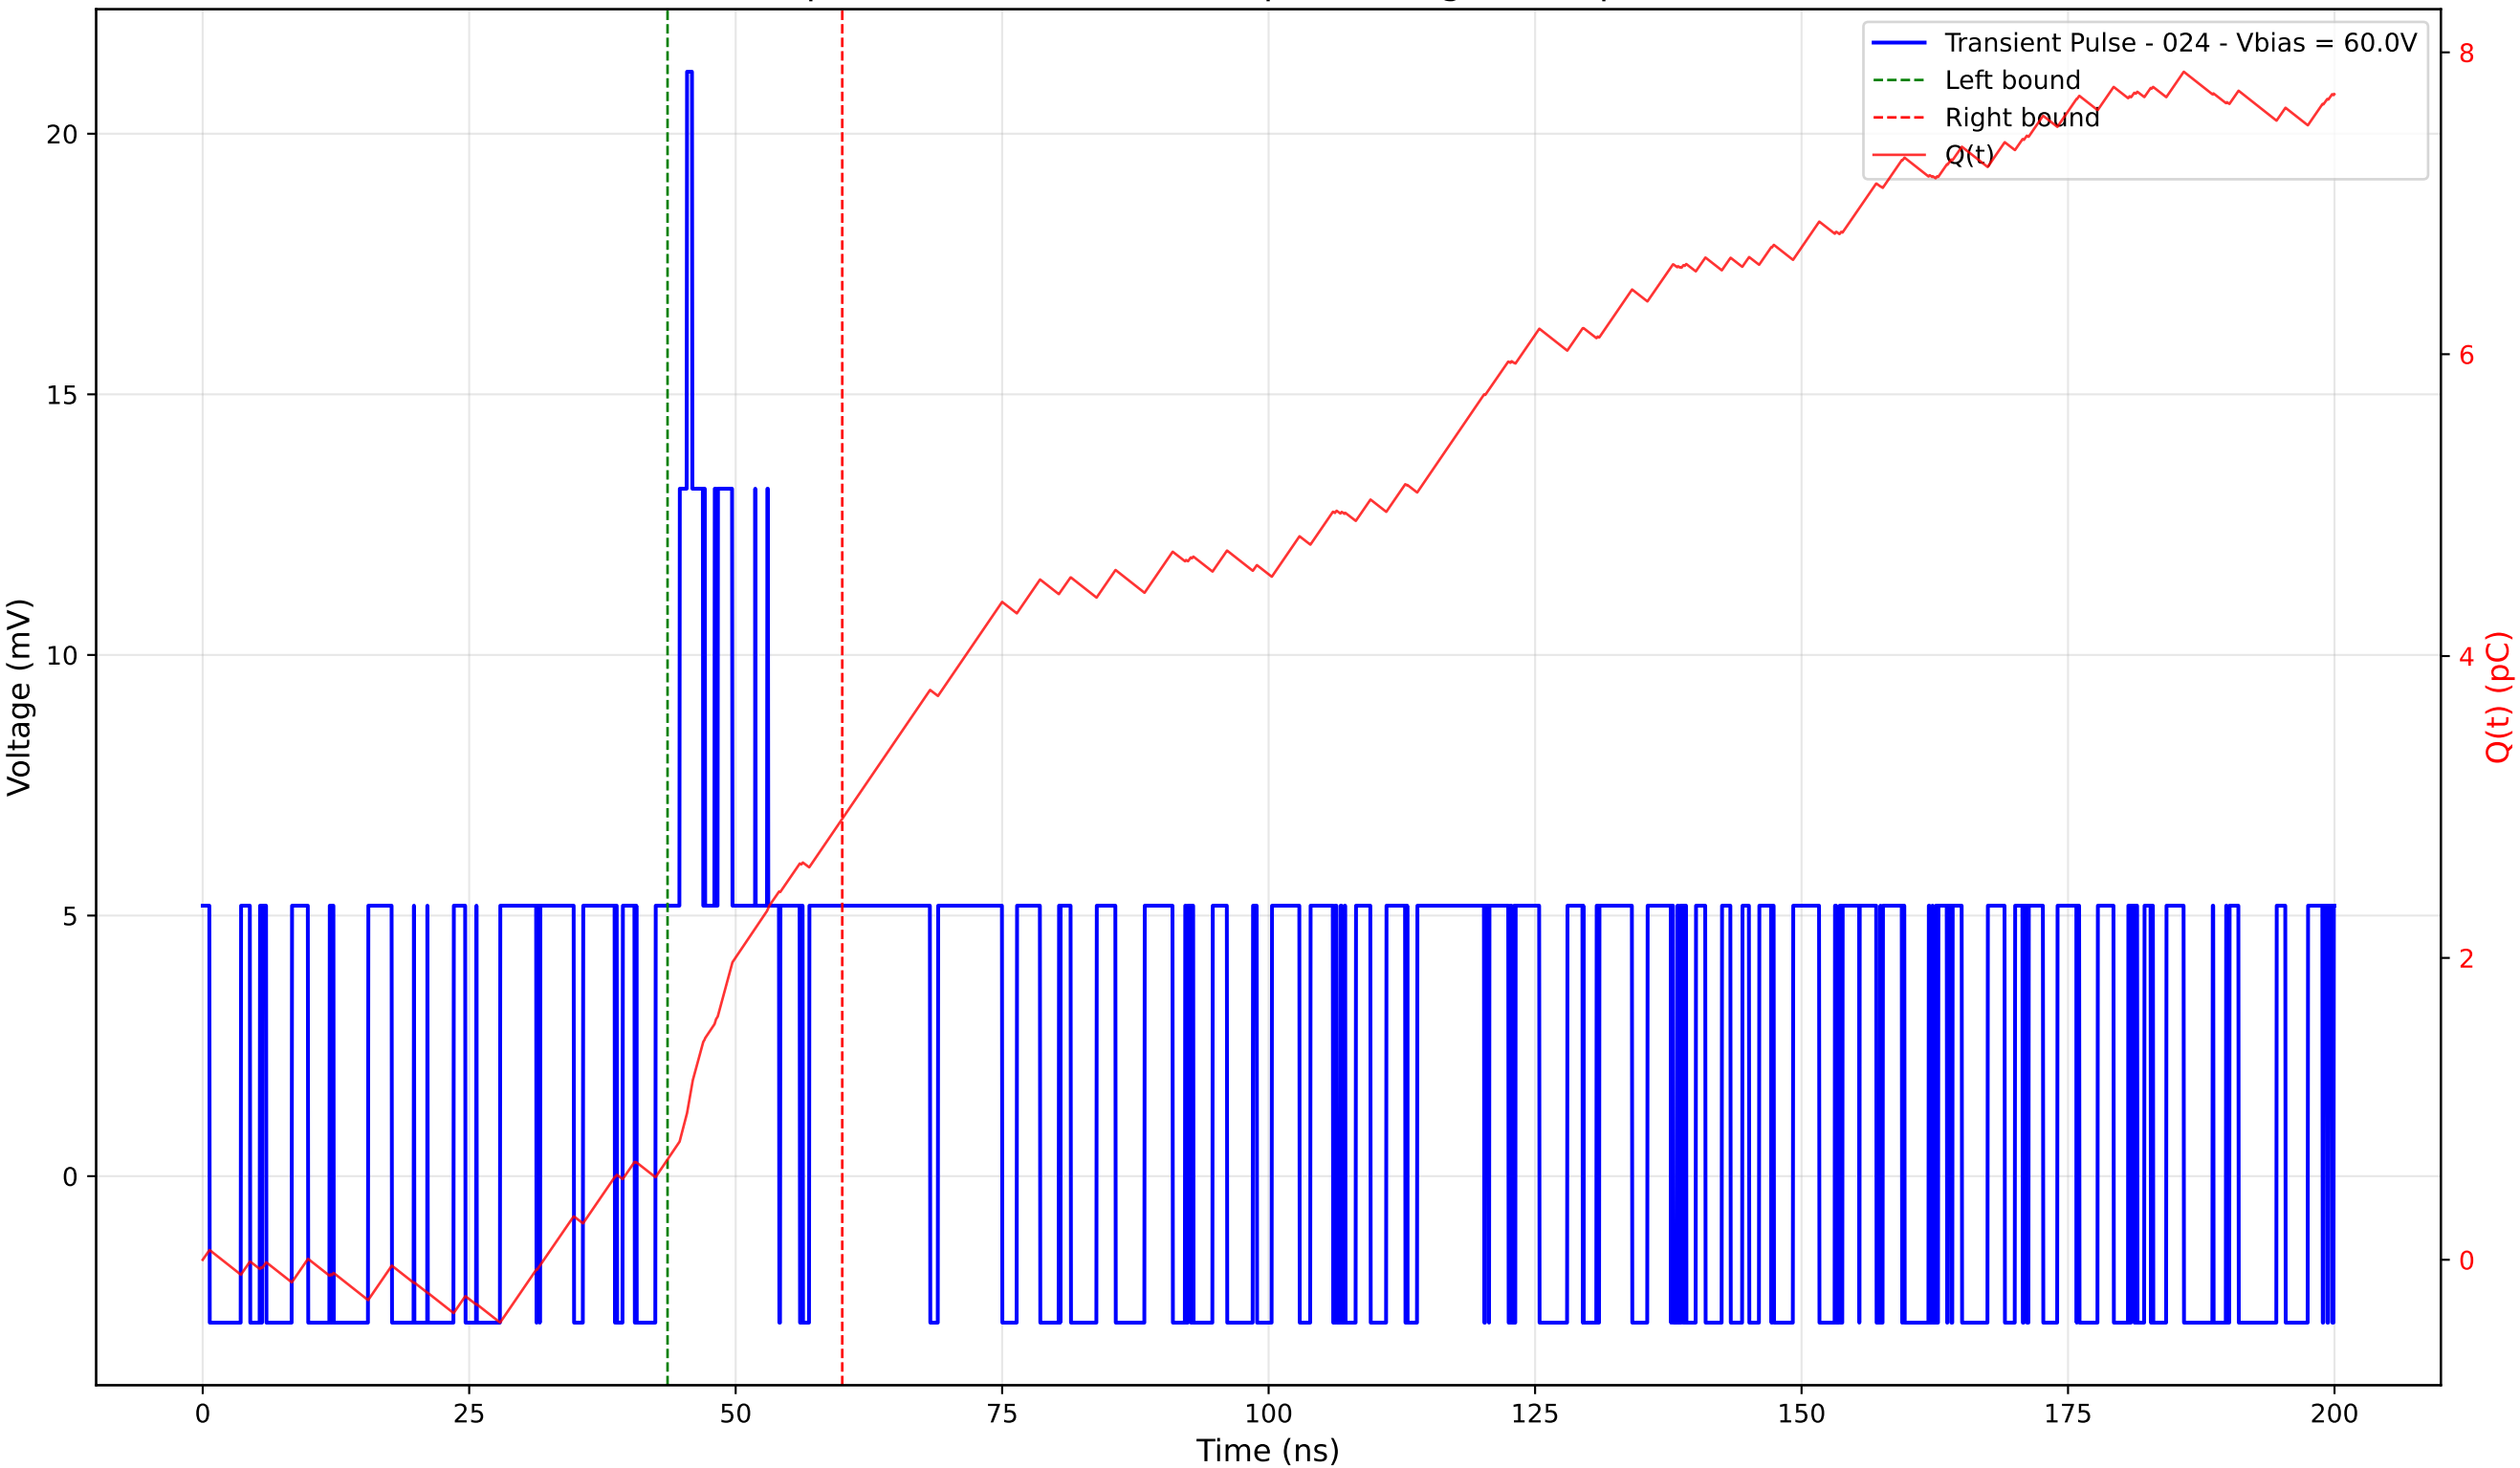


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.08 pC - Rise Time: 0.54 ns

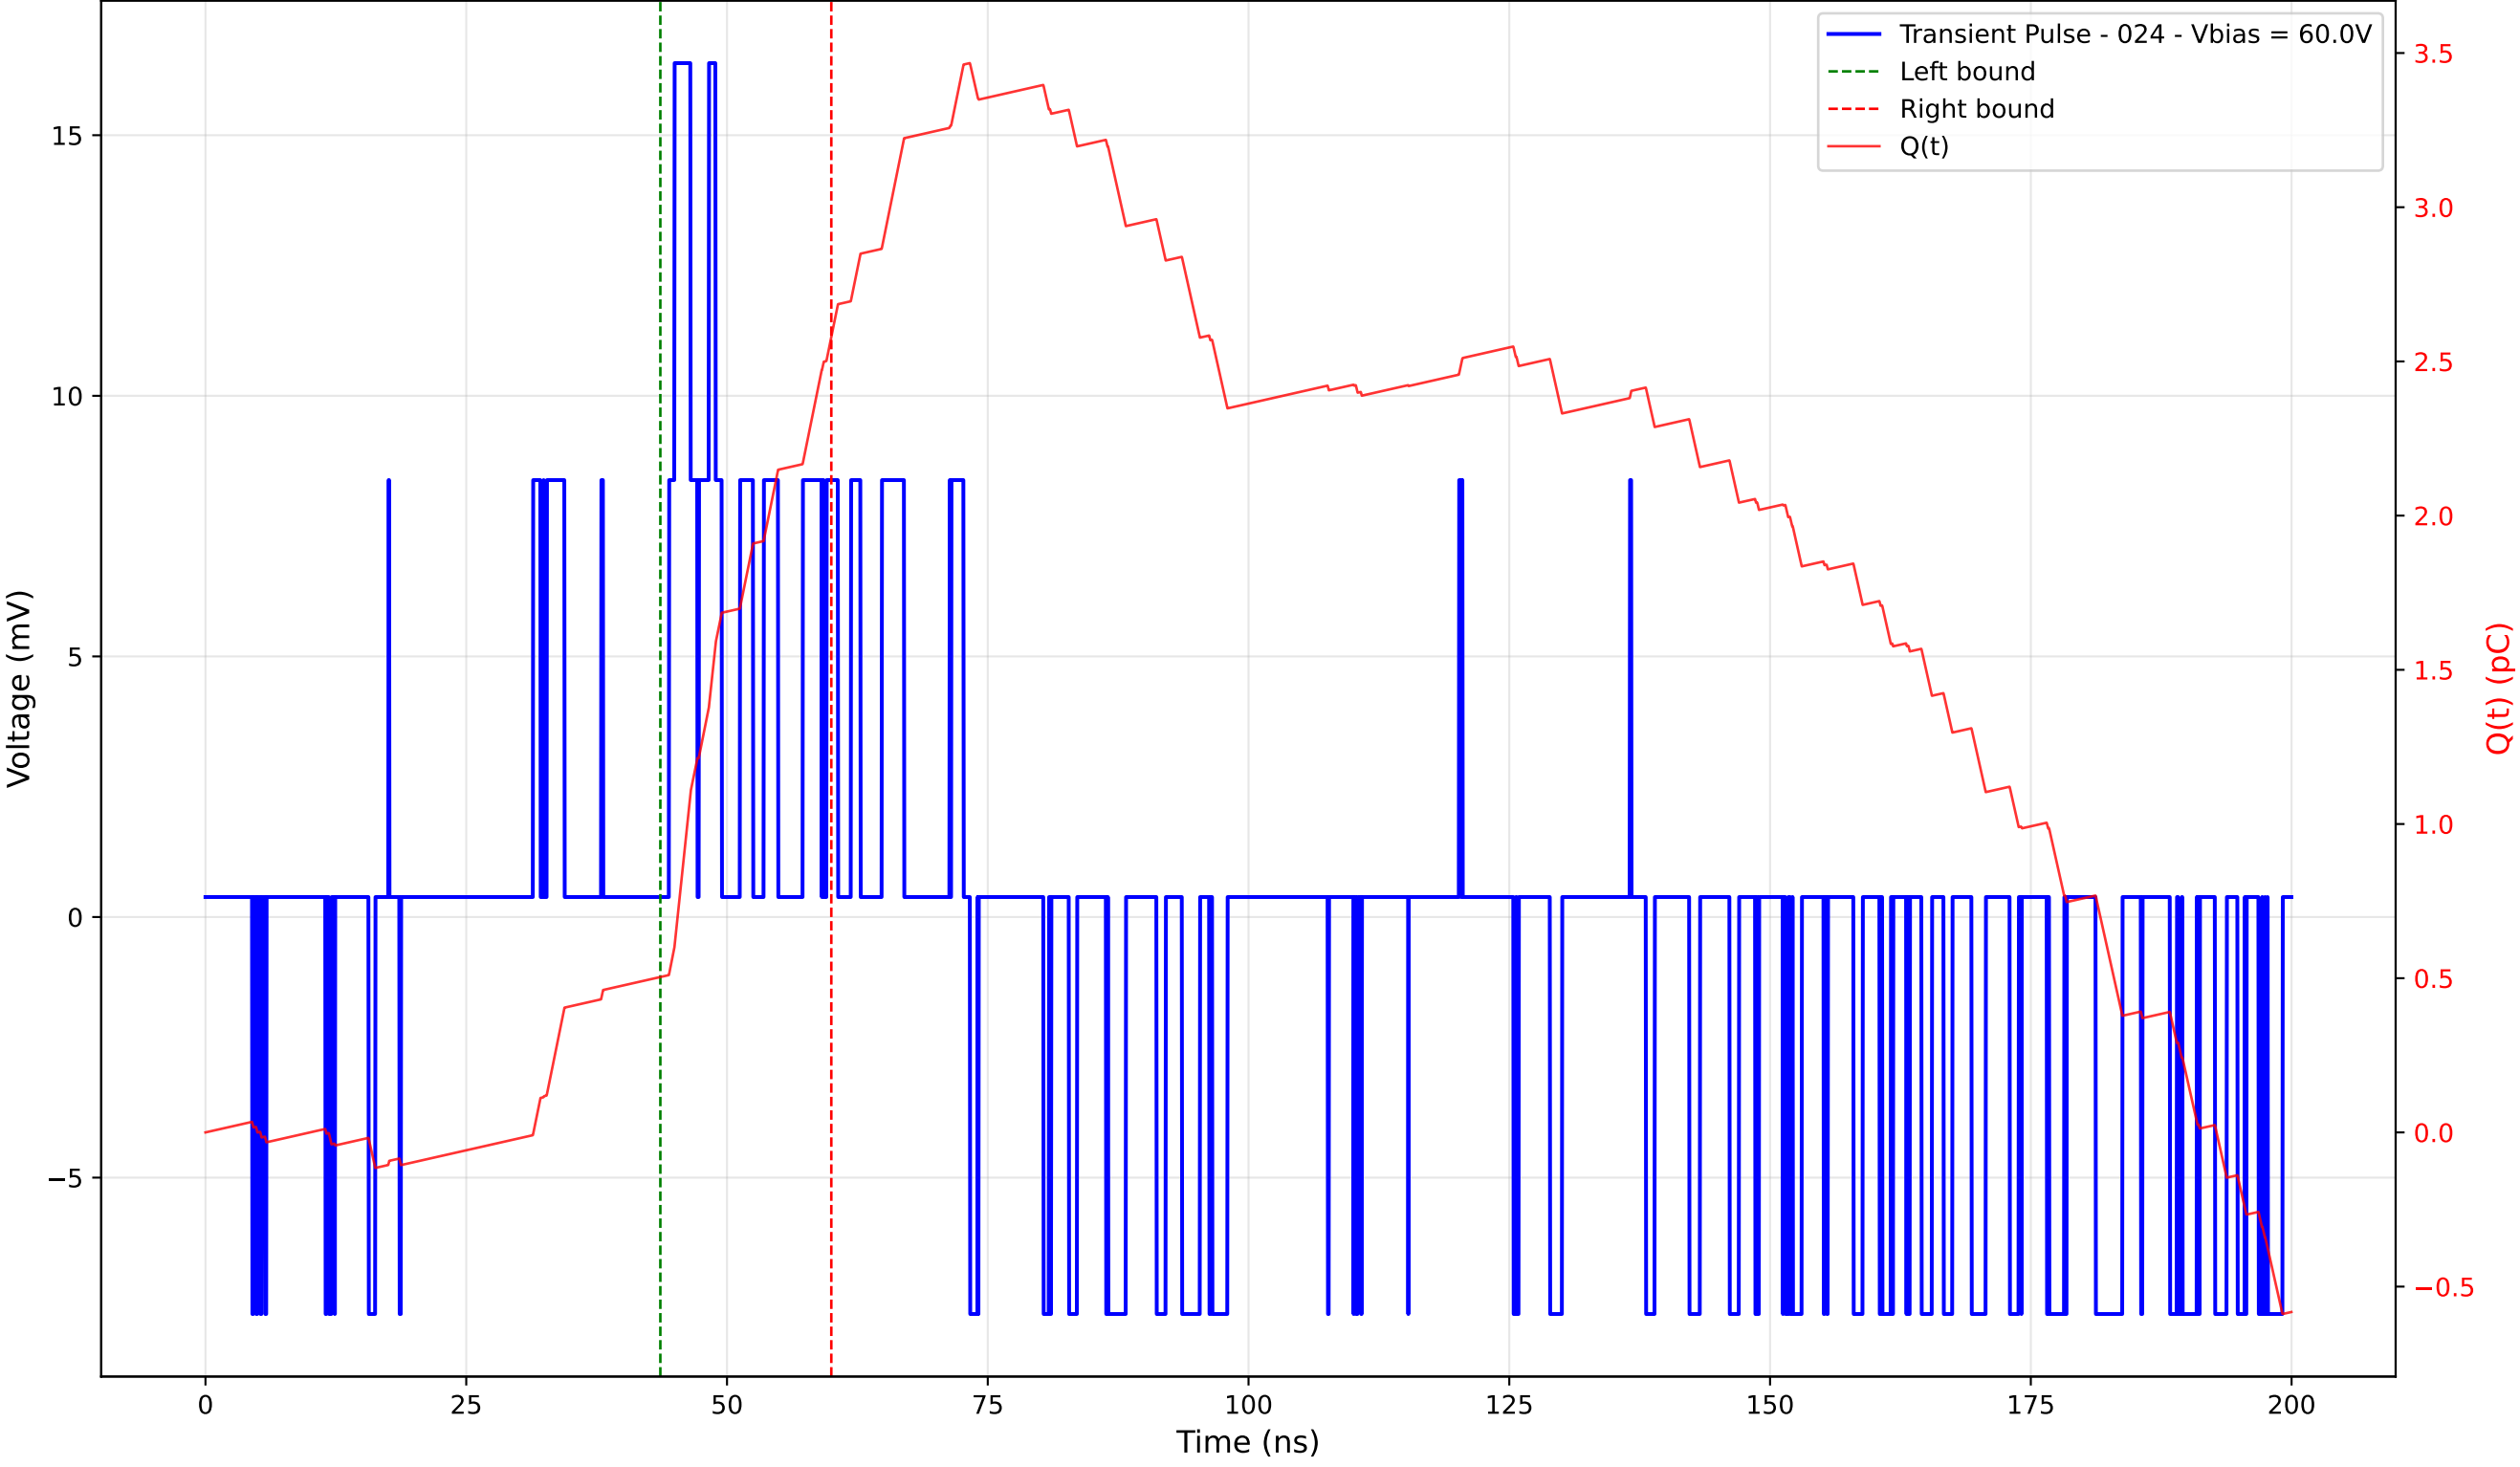


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 3.13 pC - Rise Time: 1.28 ns

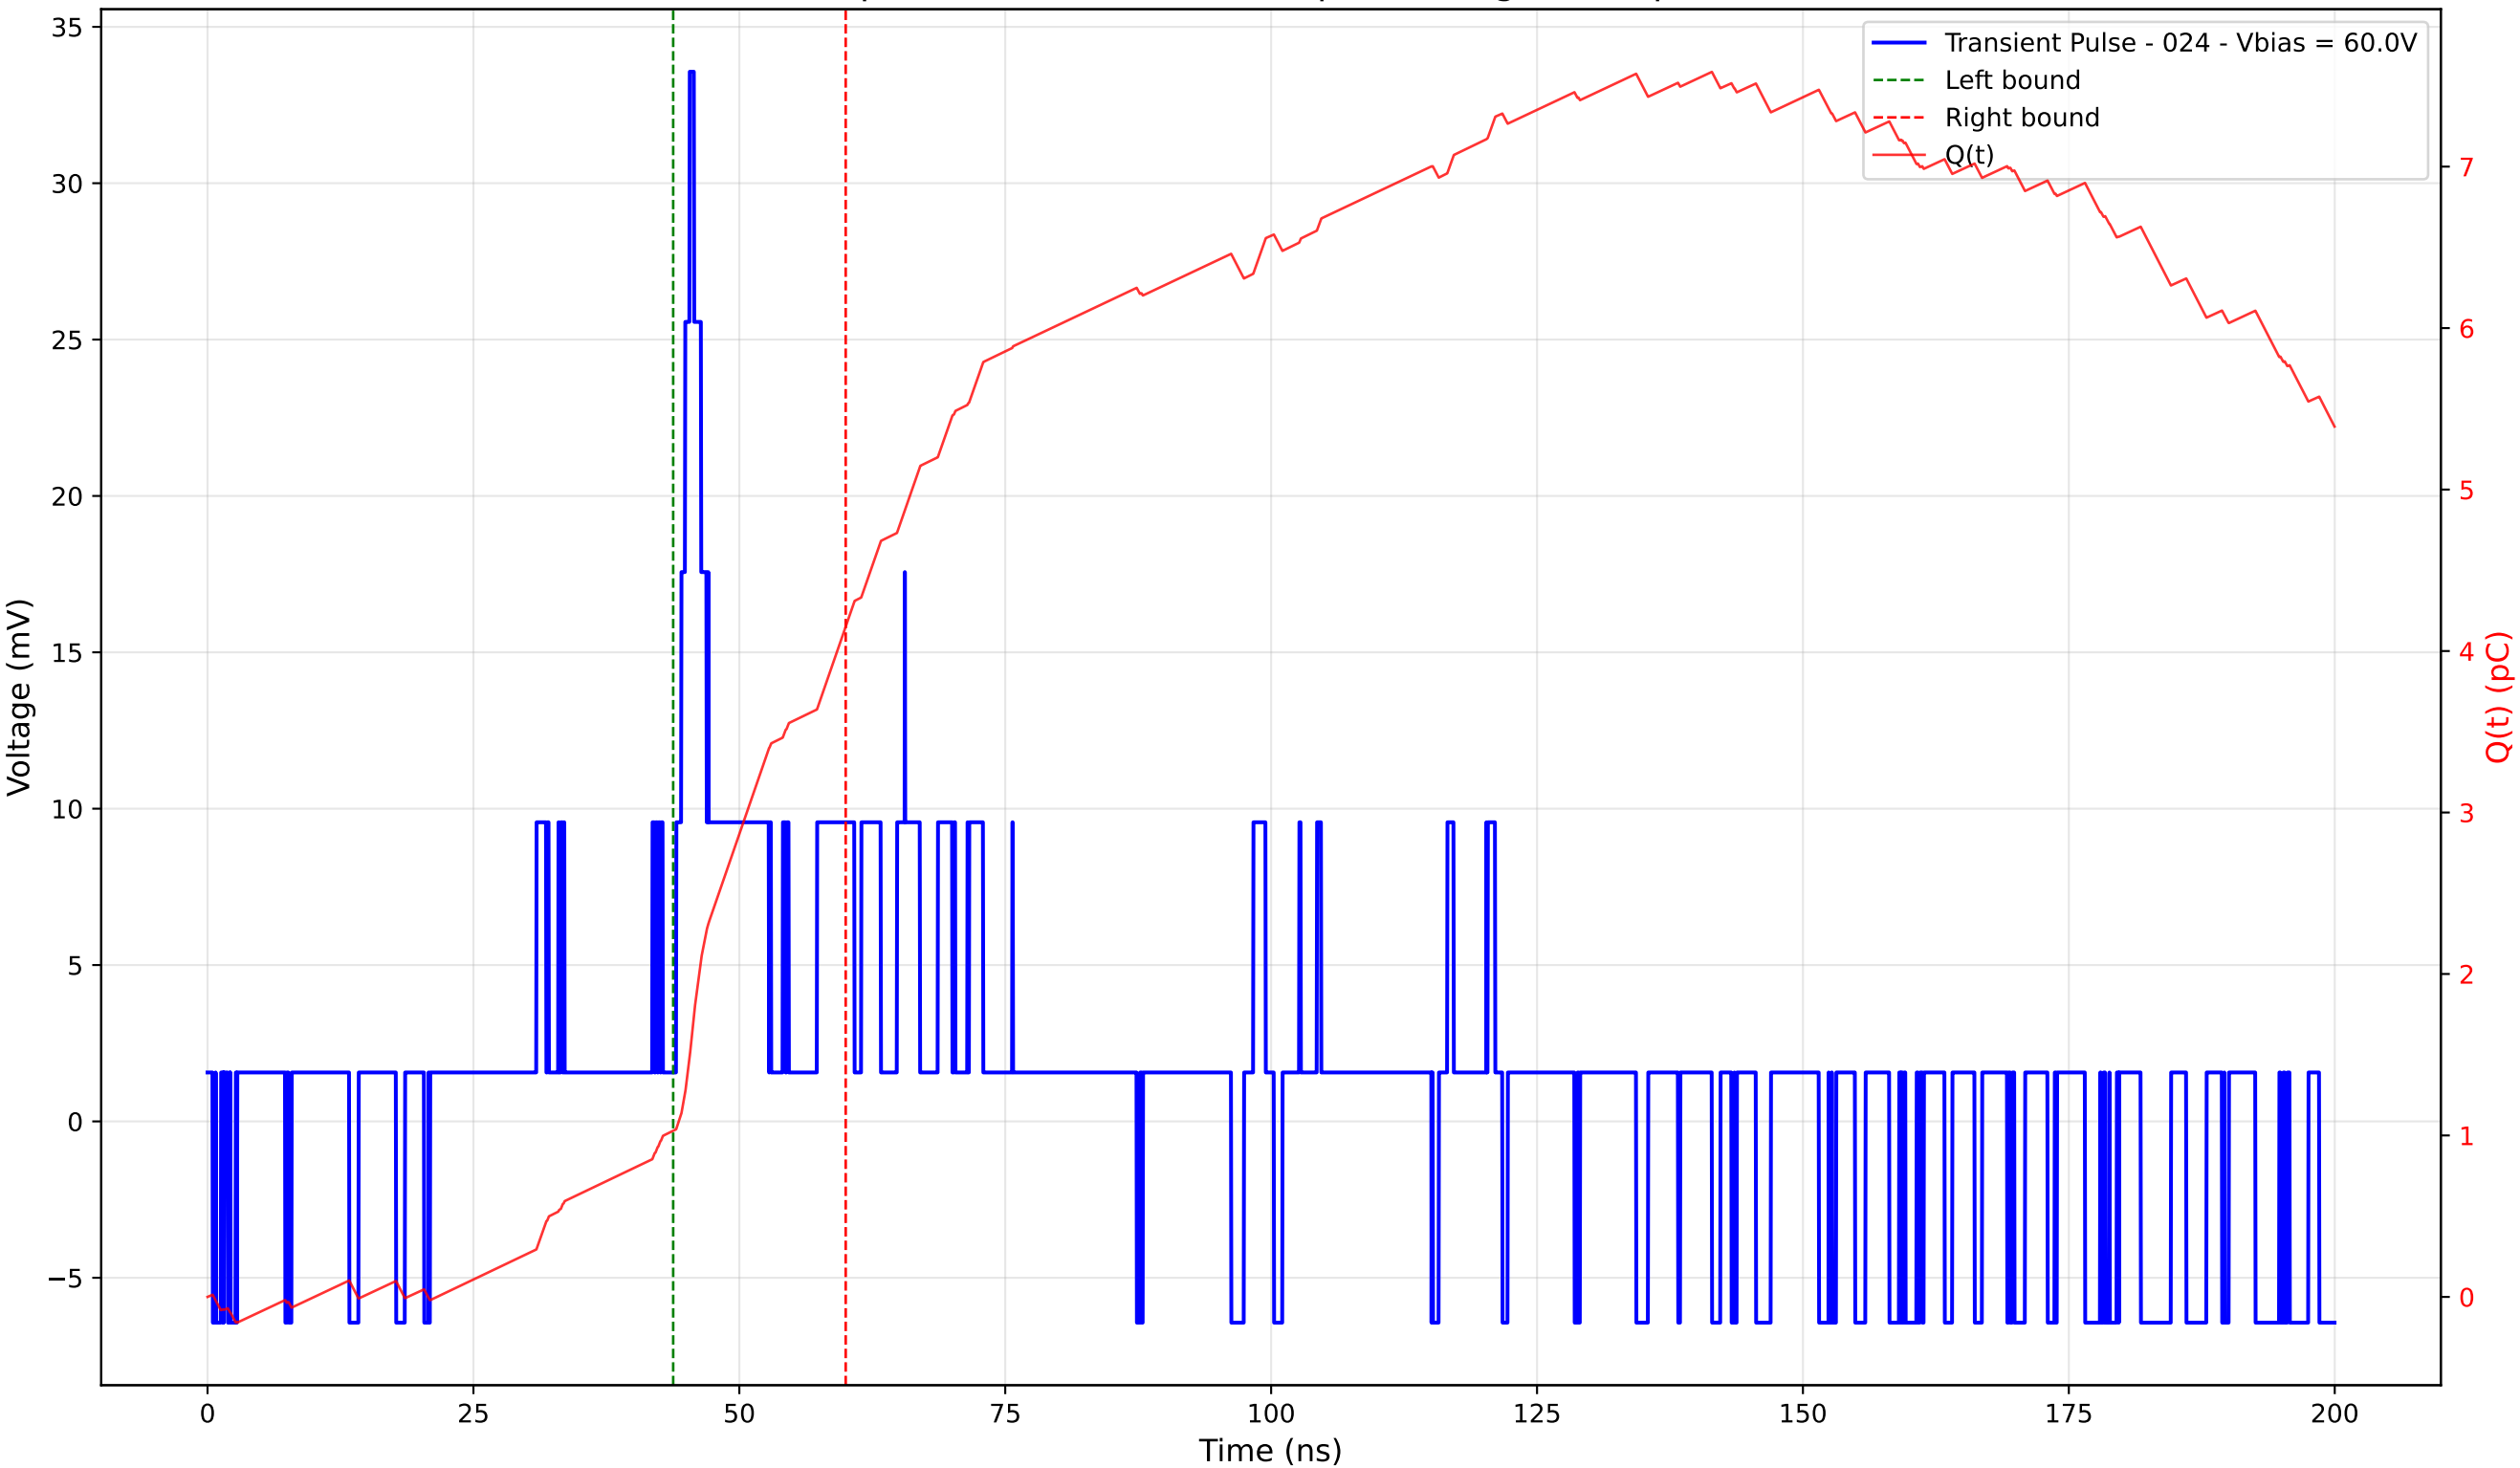


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 3.80 pC - Rise Time: 1.35 ns

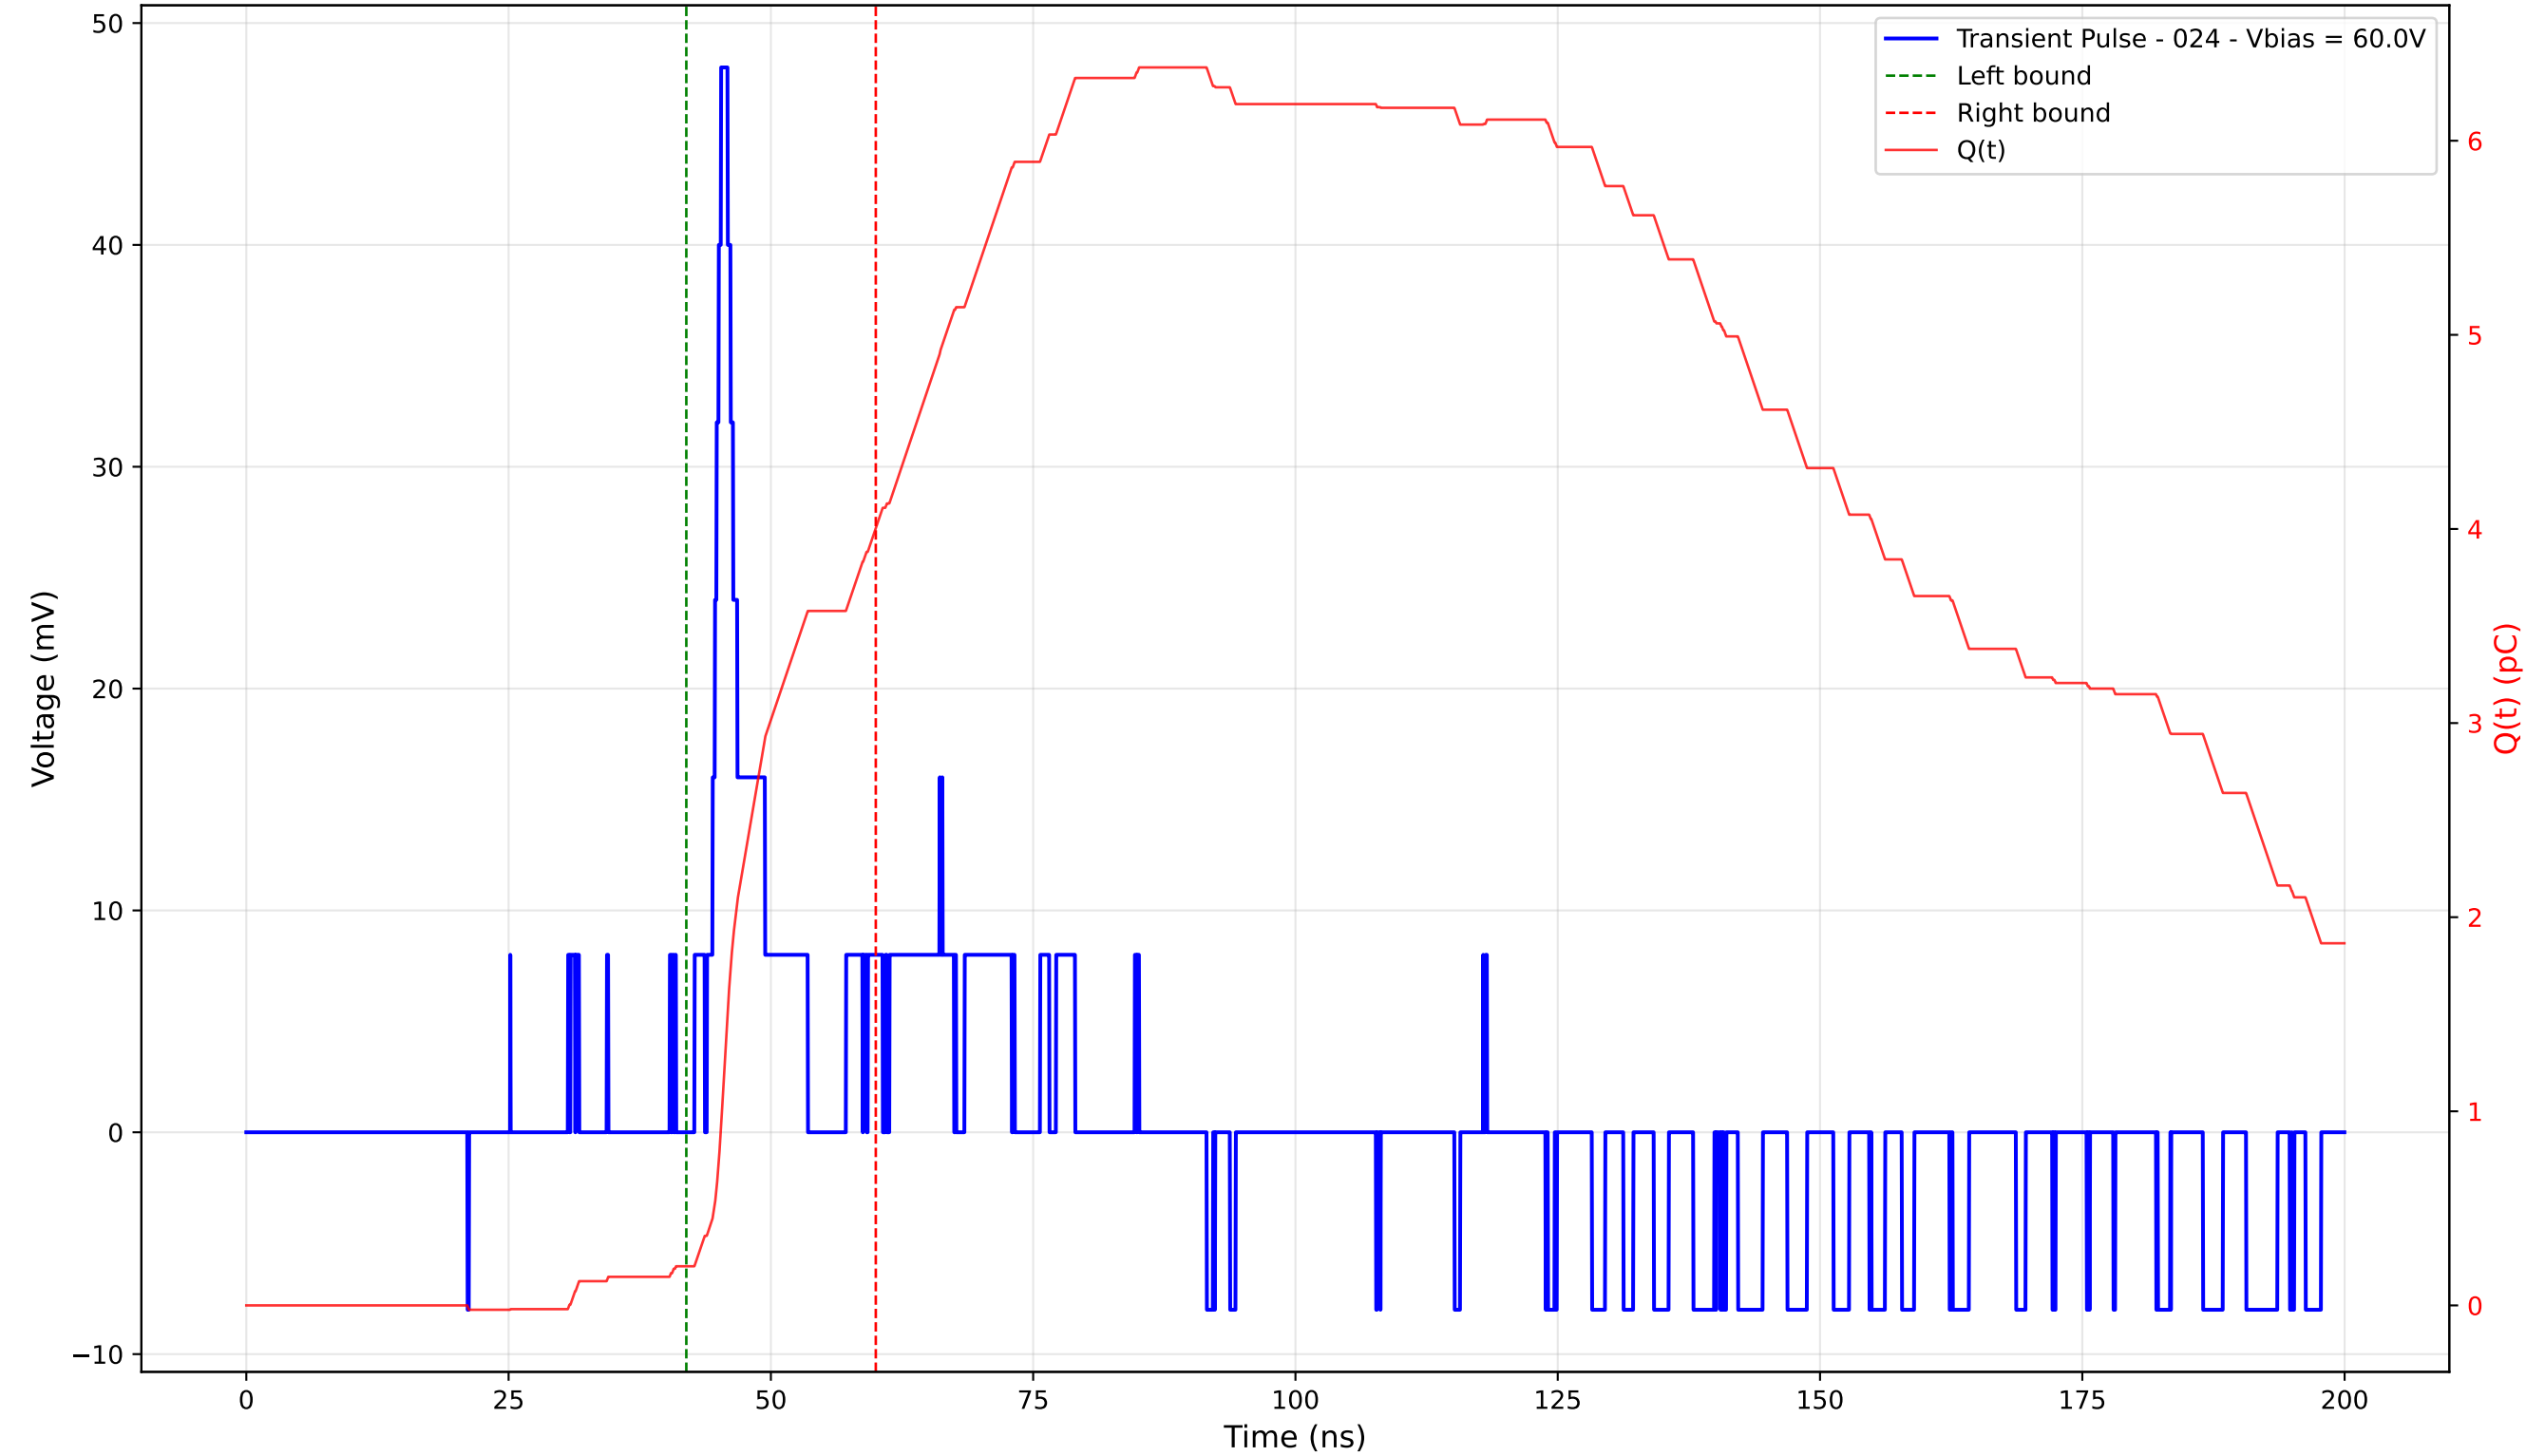


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 6.18 pC - Rise Time: 1.06 ns

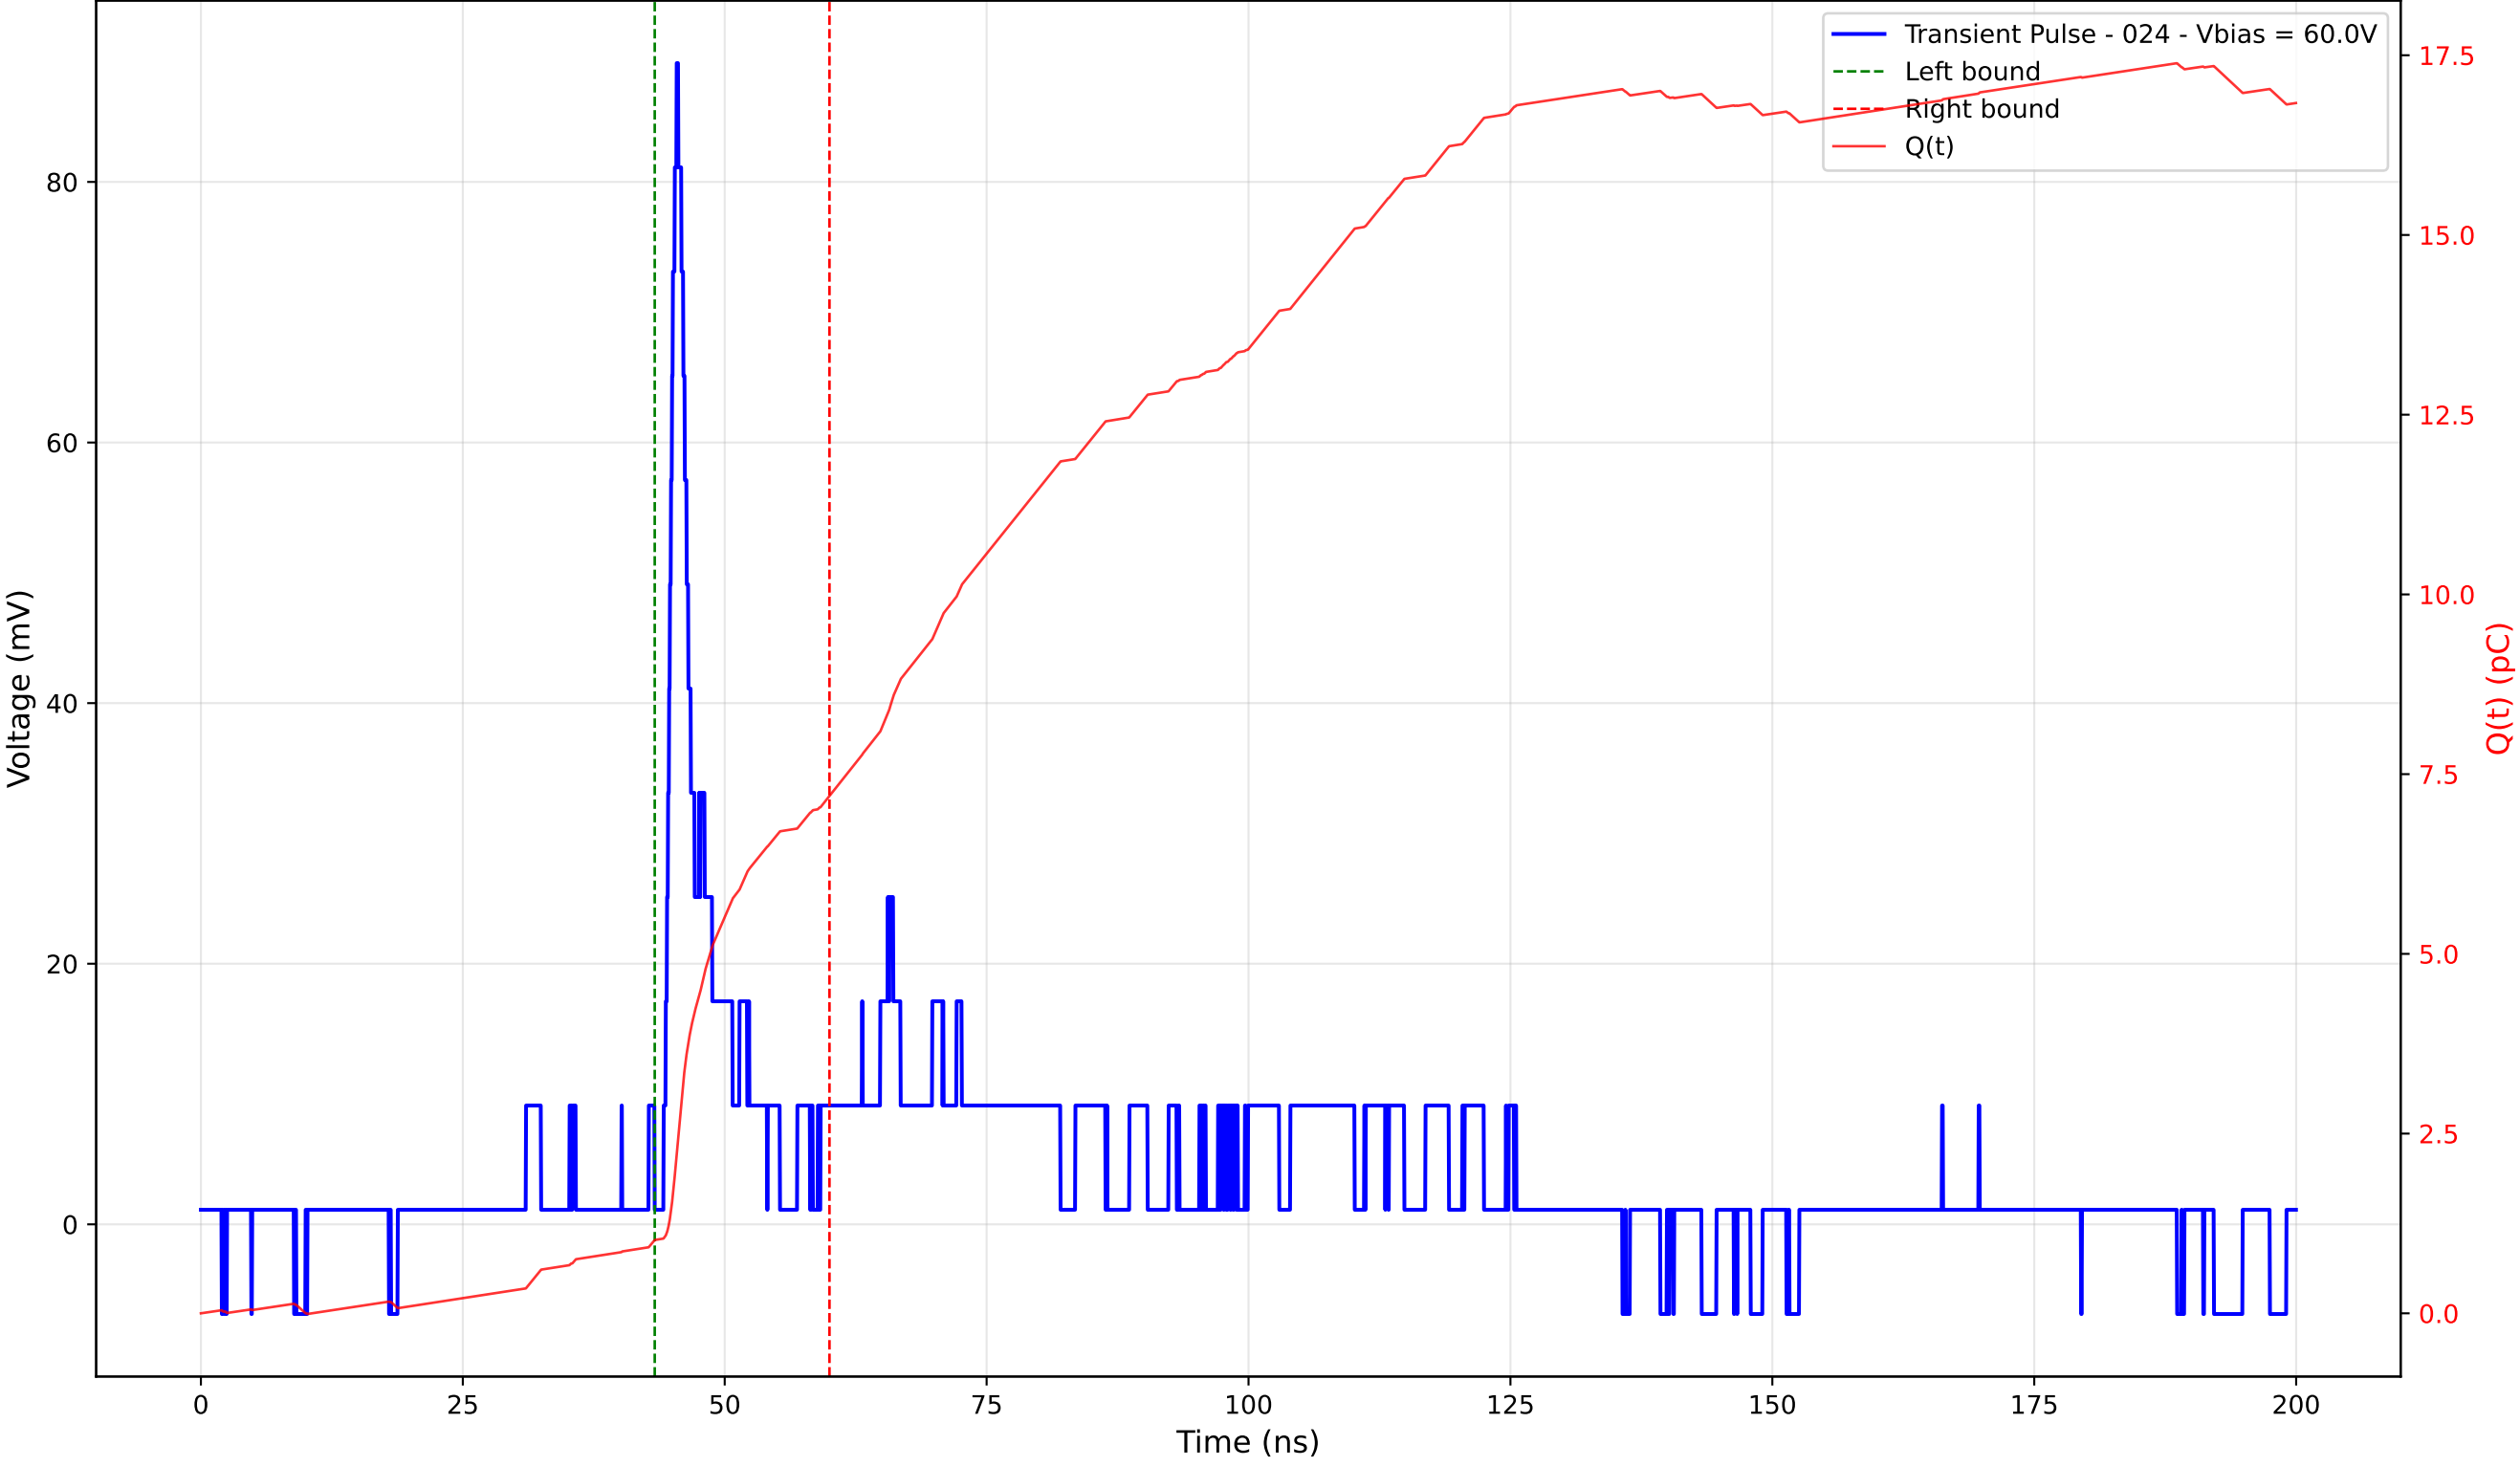


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 9.30 pC - Rise Time: 0.98 ns

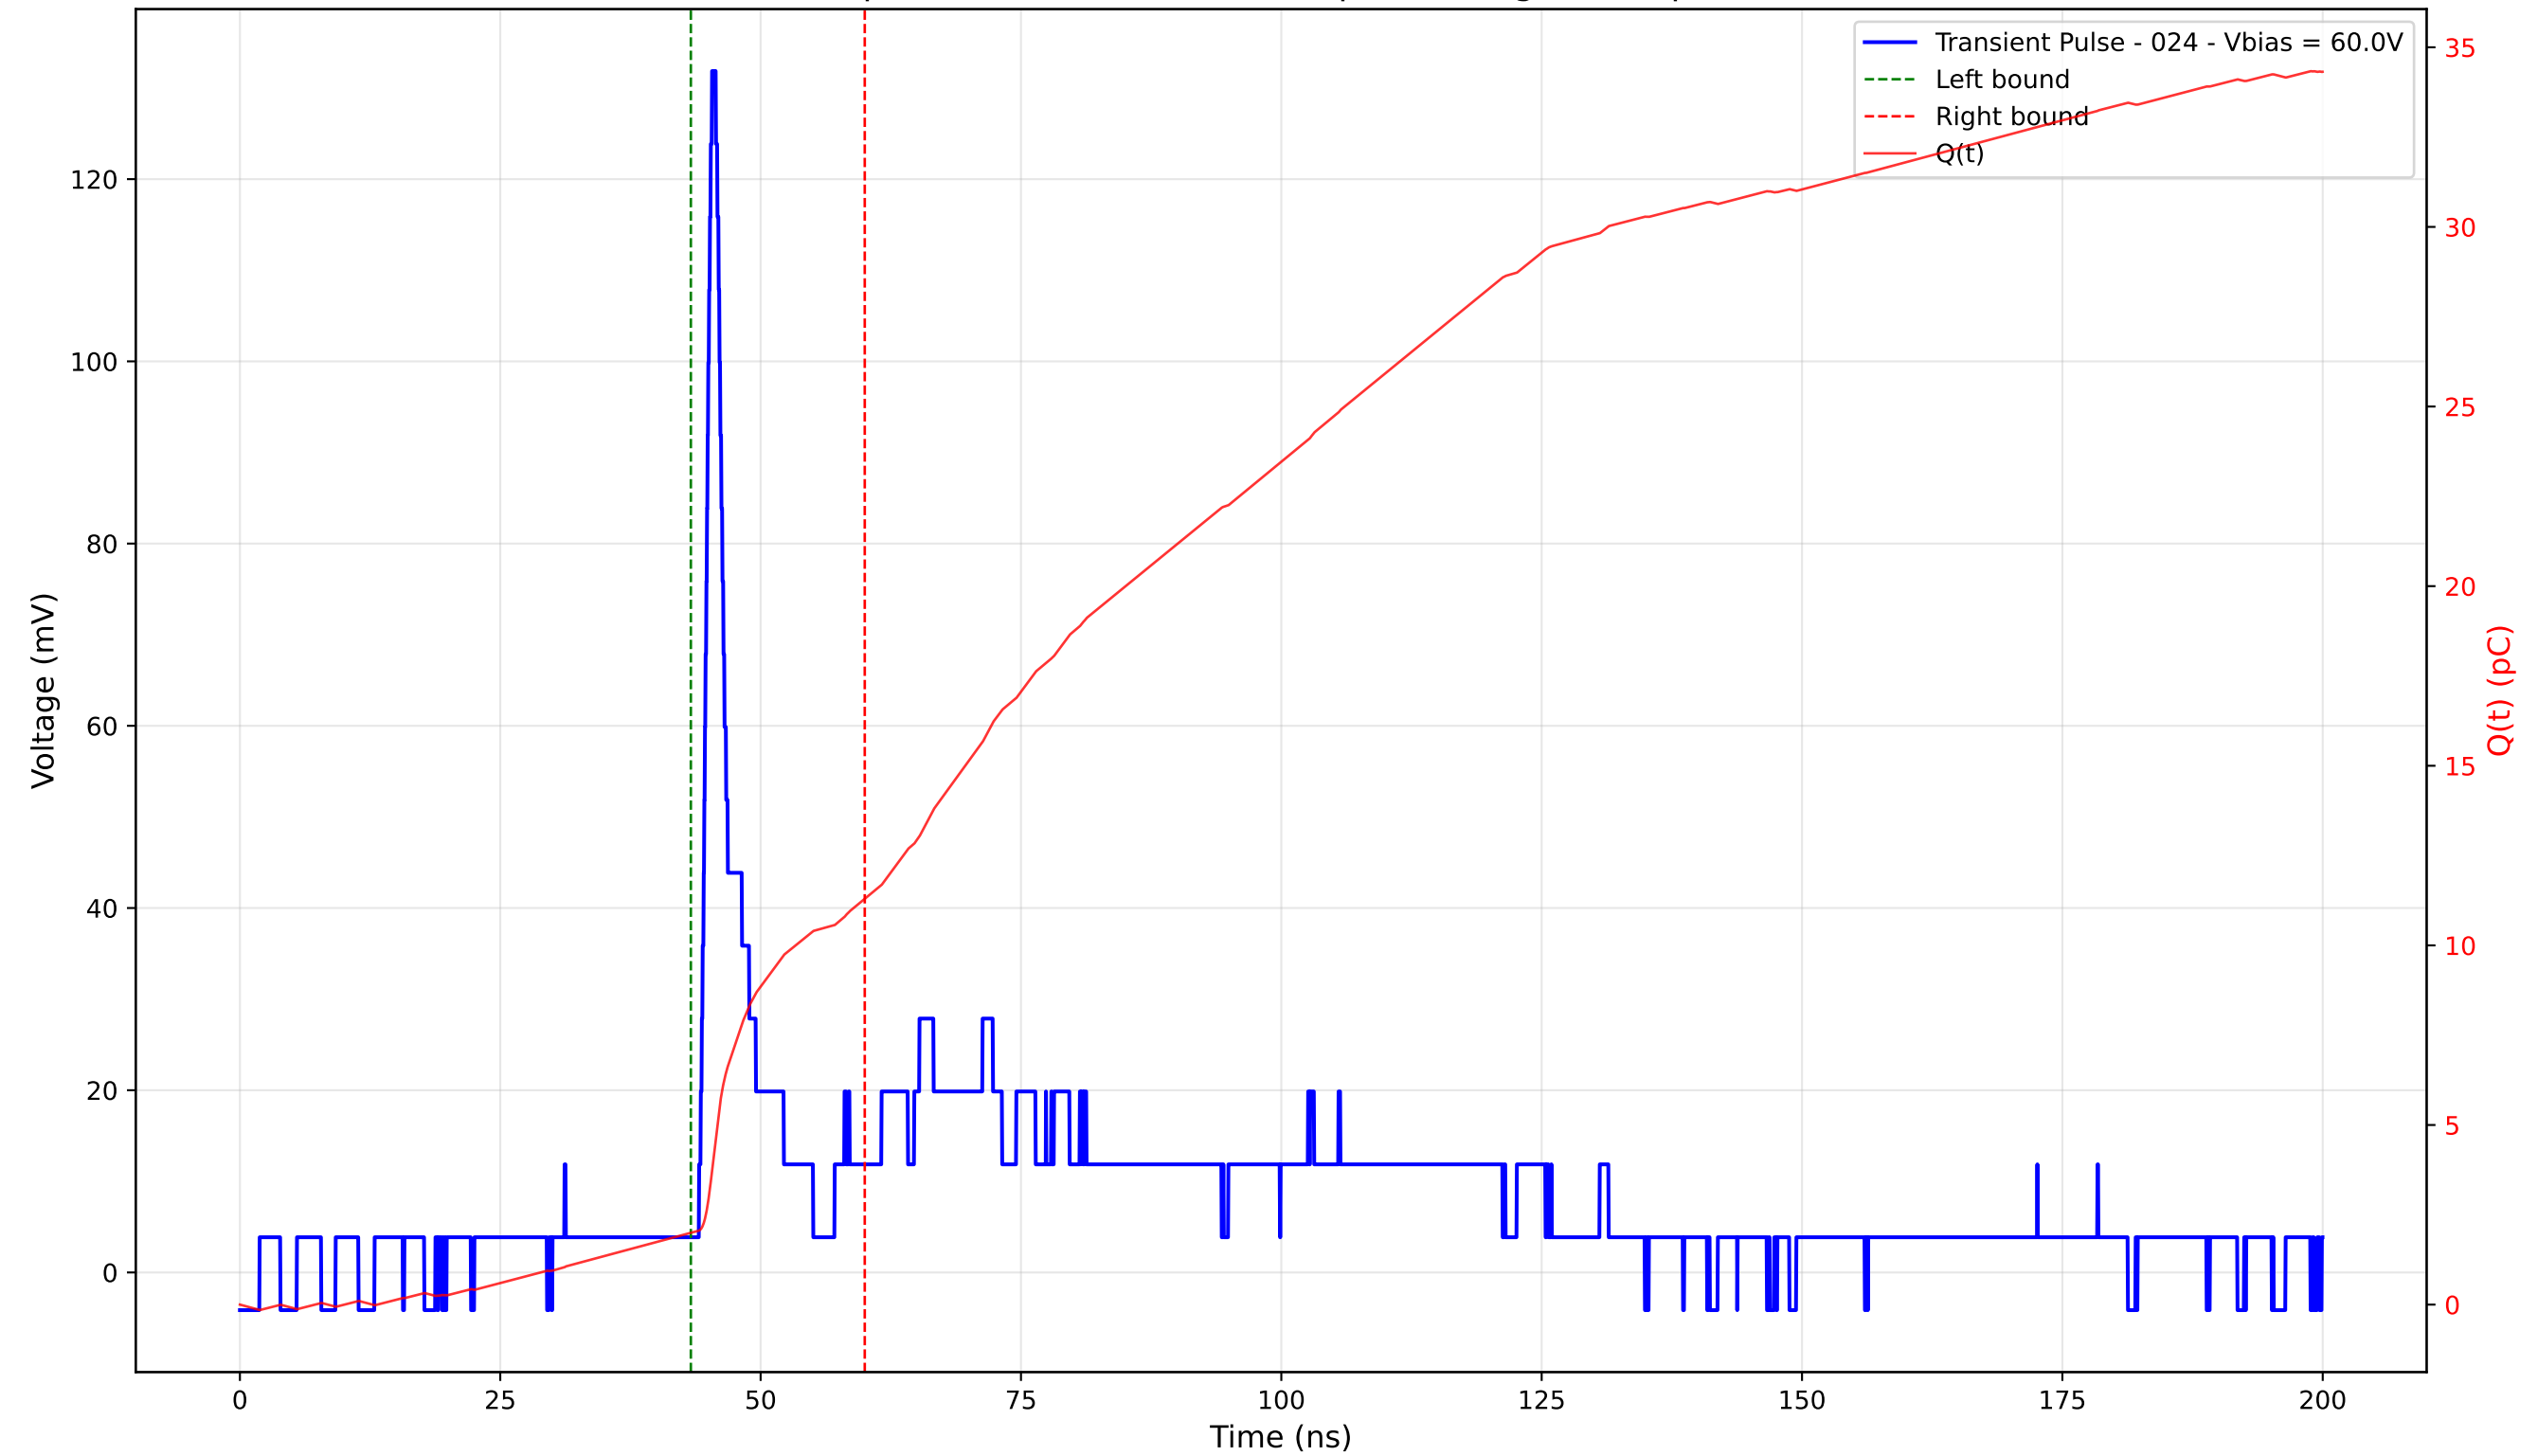


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 11.76 pC - Rise Time: 0.93 ns

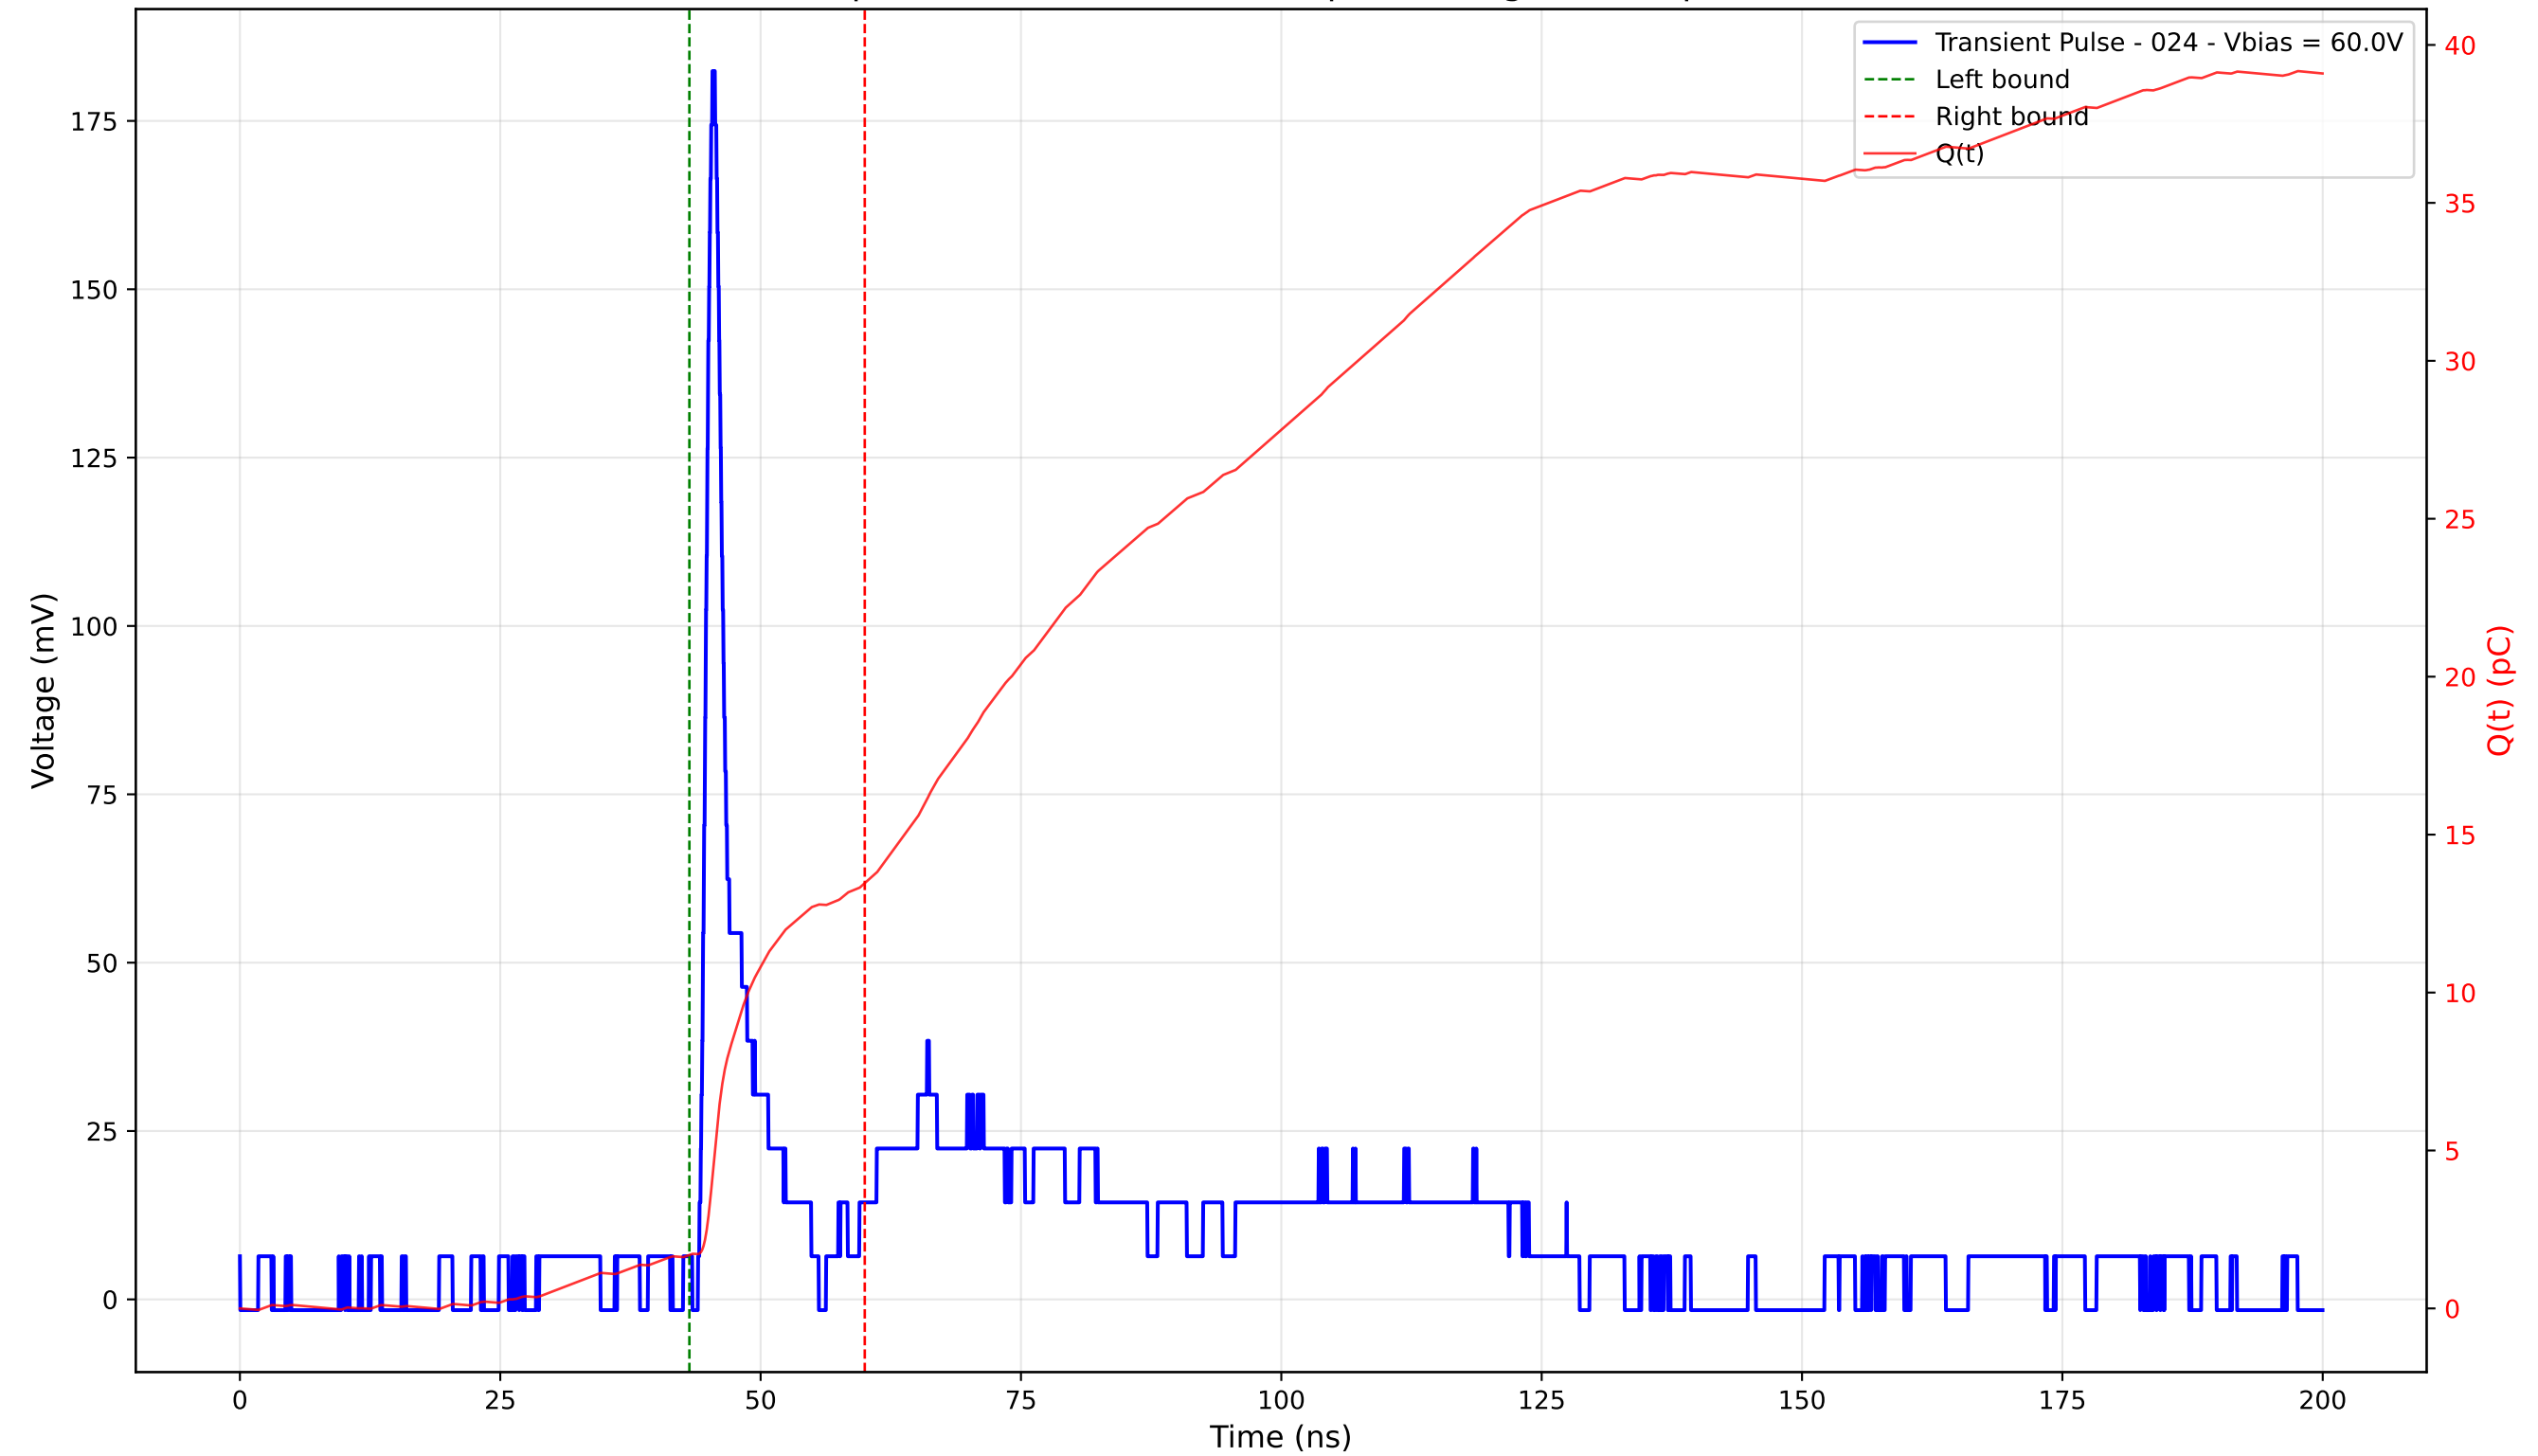


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 13.26 pC - Rise Time: 0.95 ns

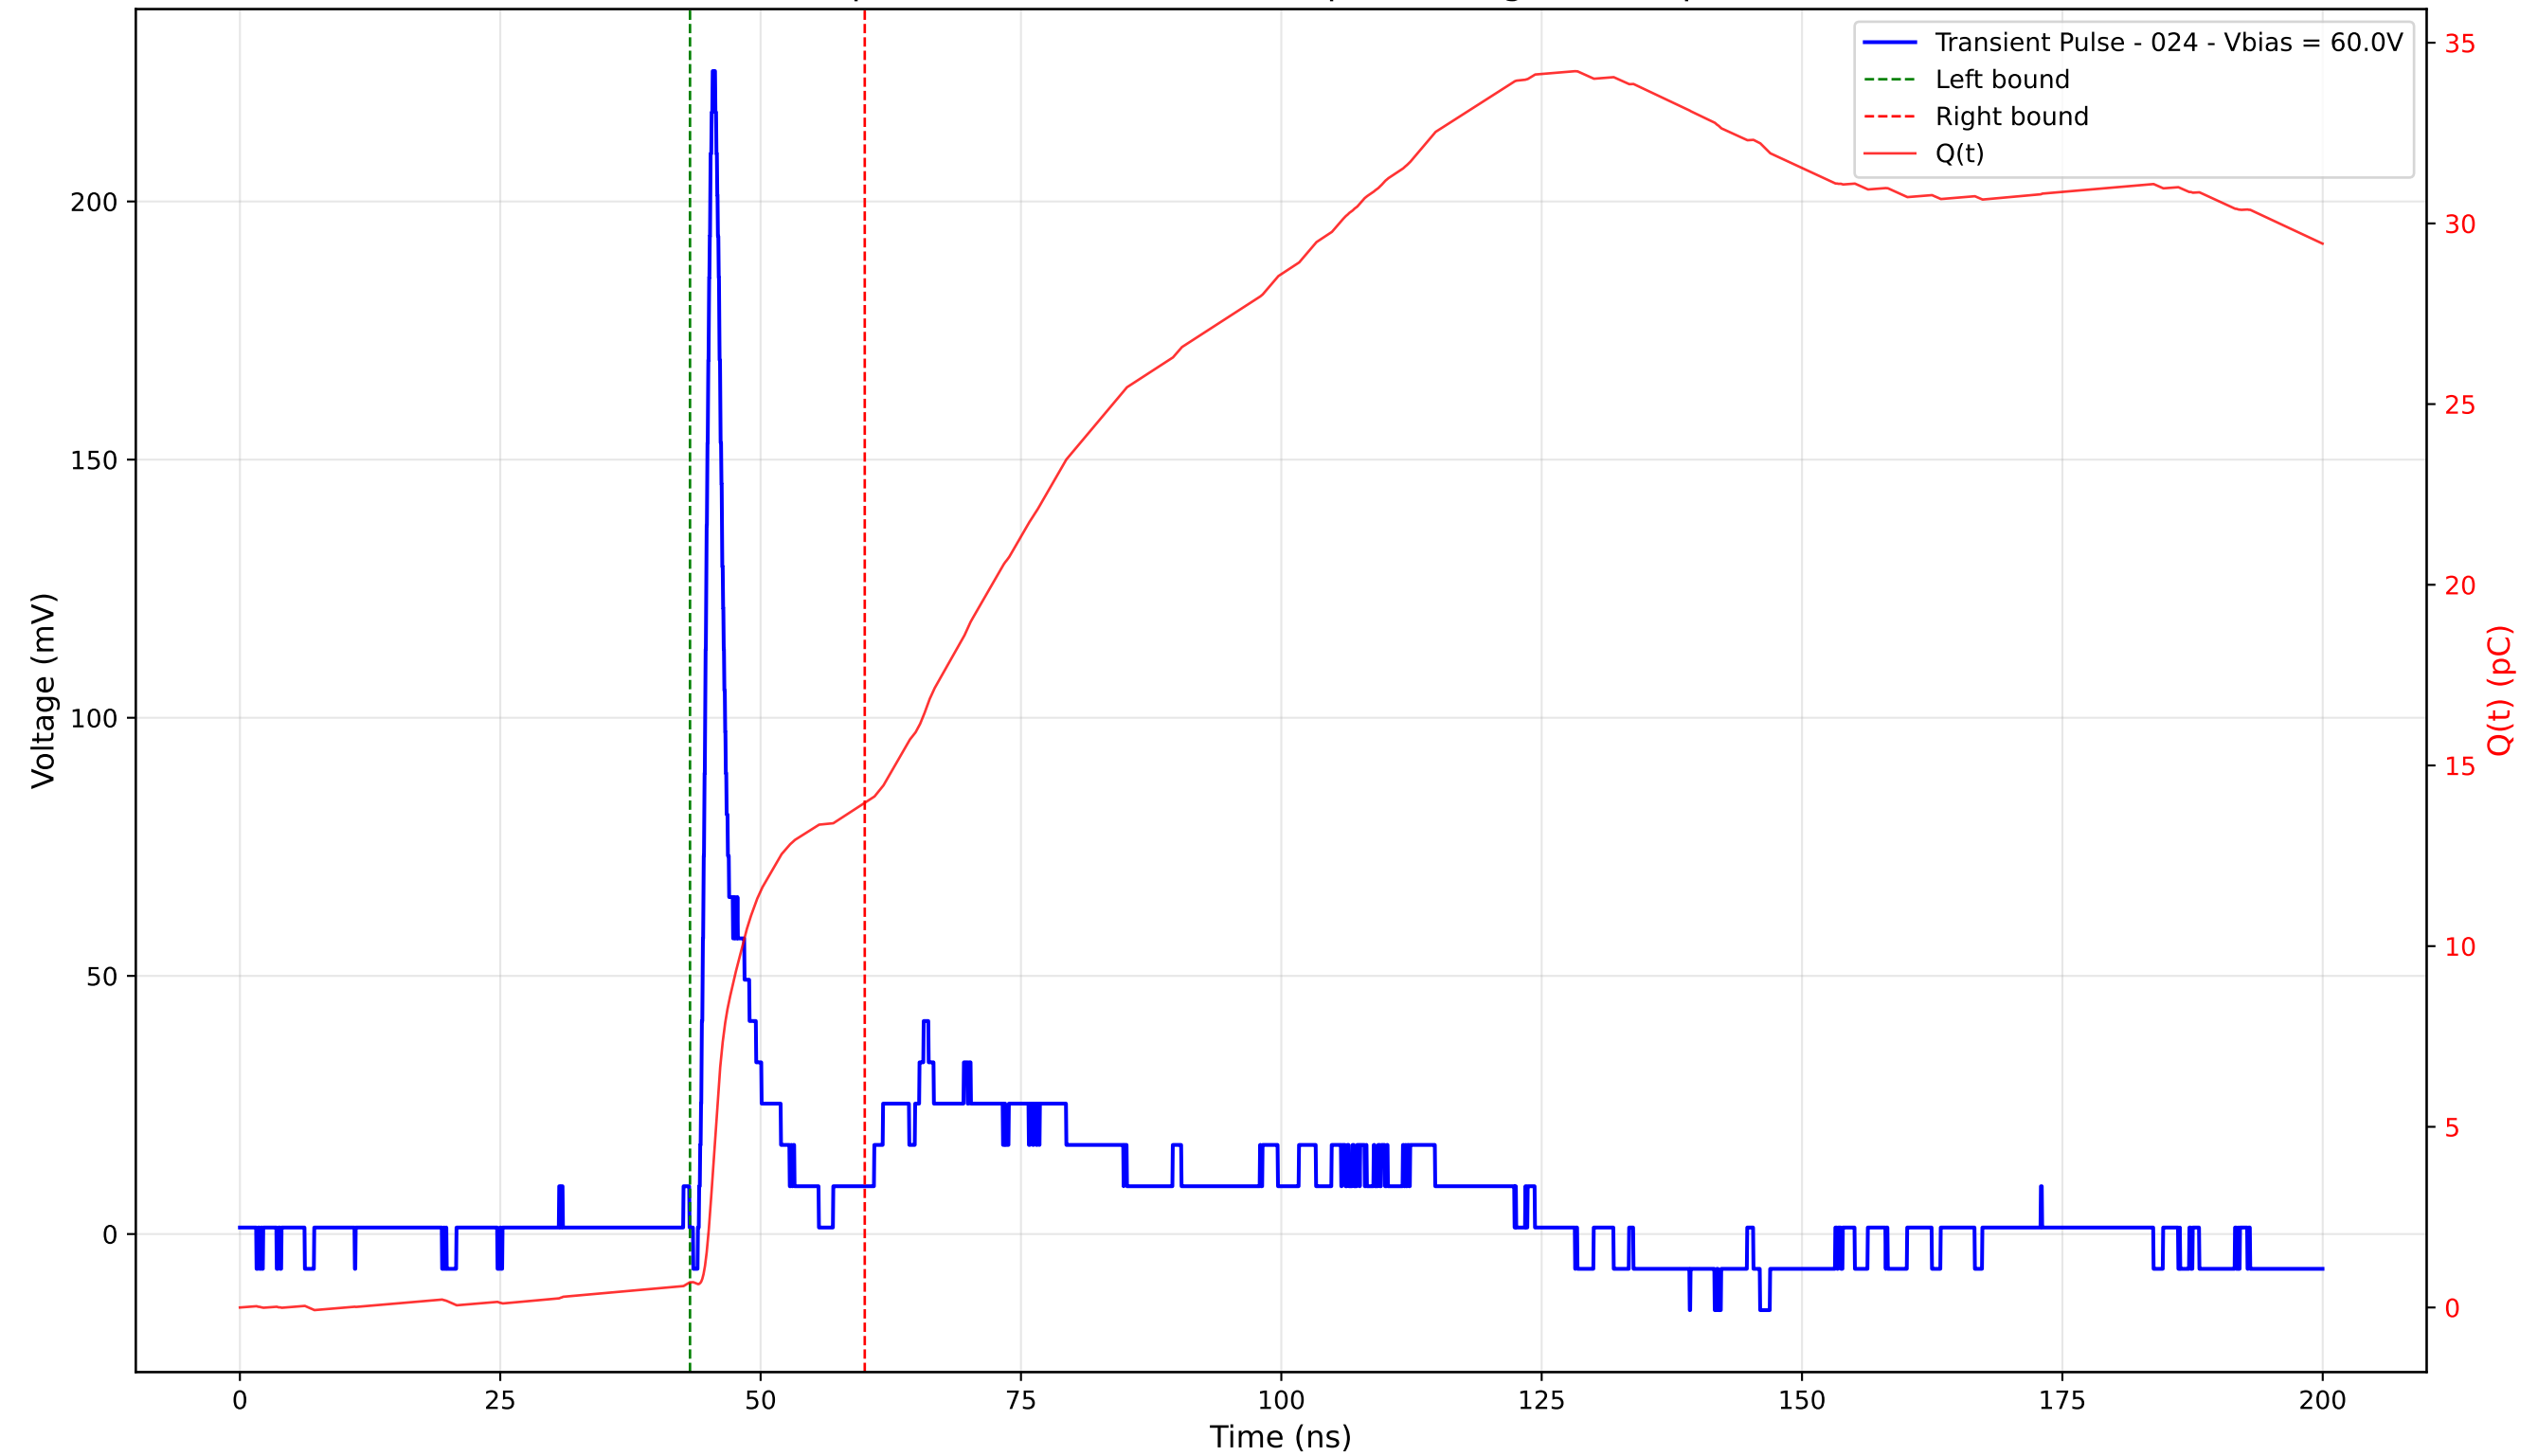


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 16.87 pC - Rise Time: 0.98 ns

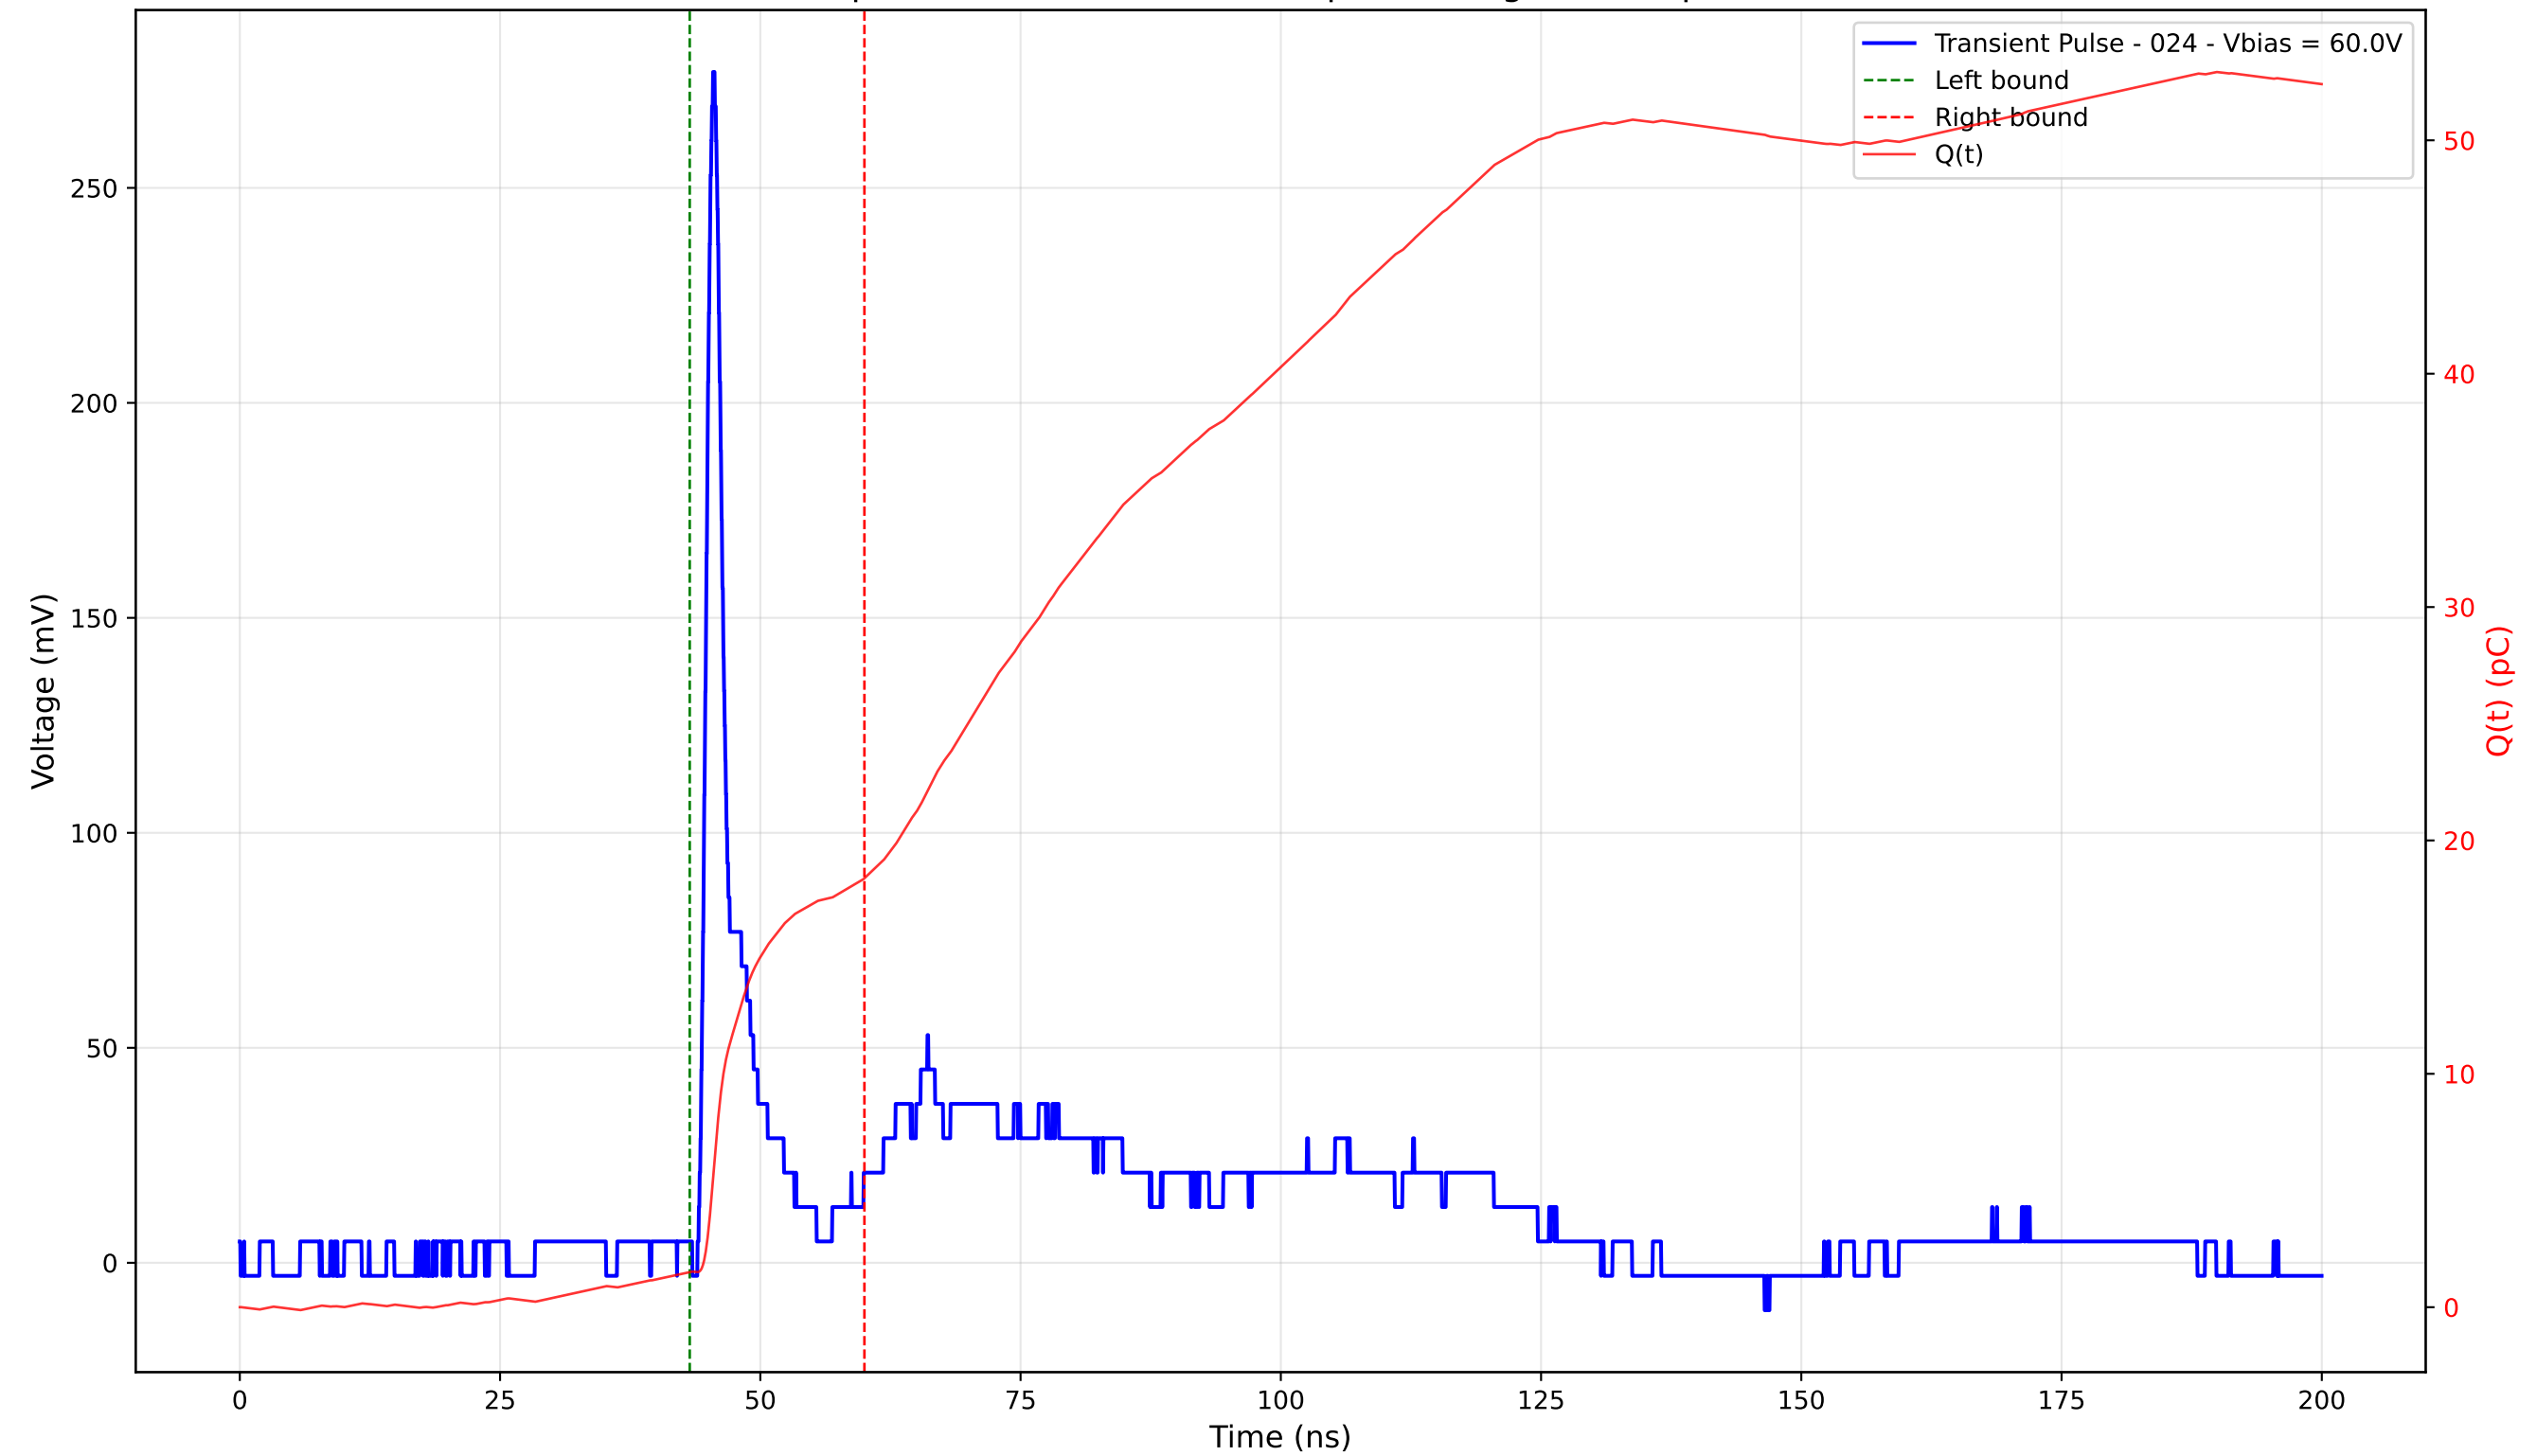


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 17.93 pC - Rise Time: 0.96 ns

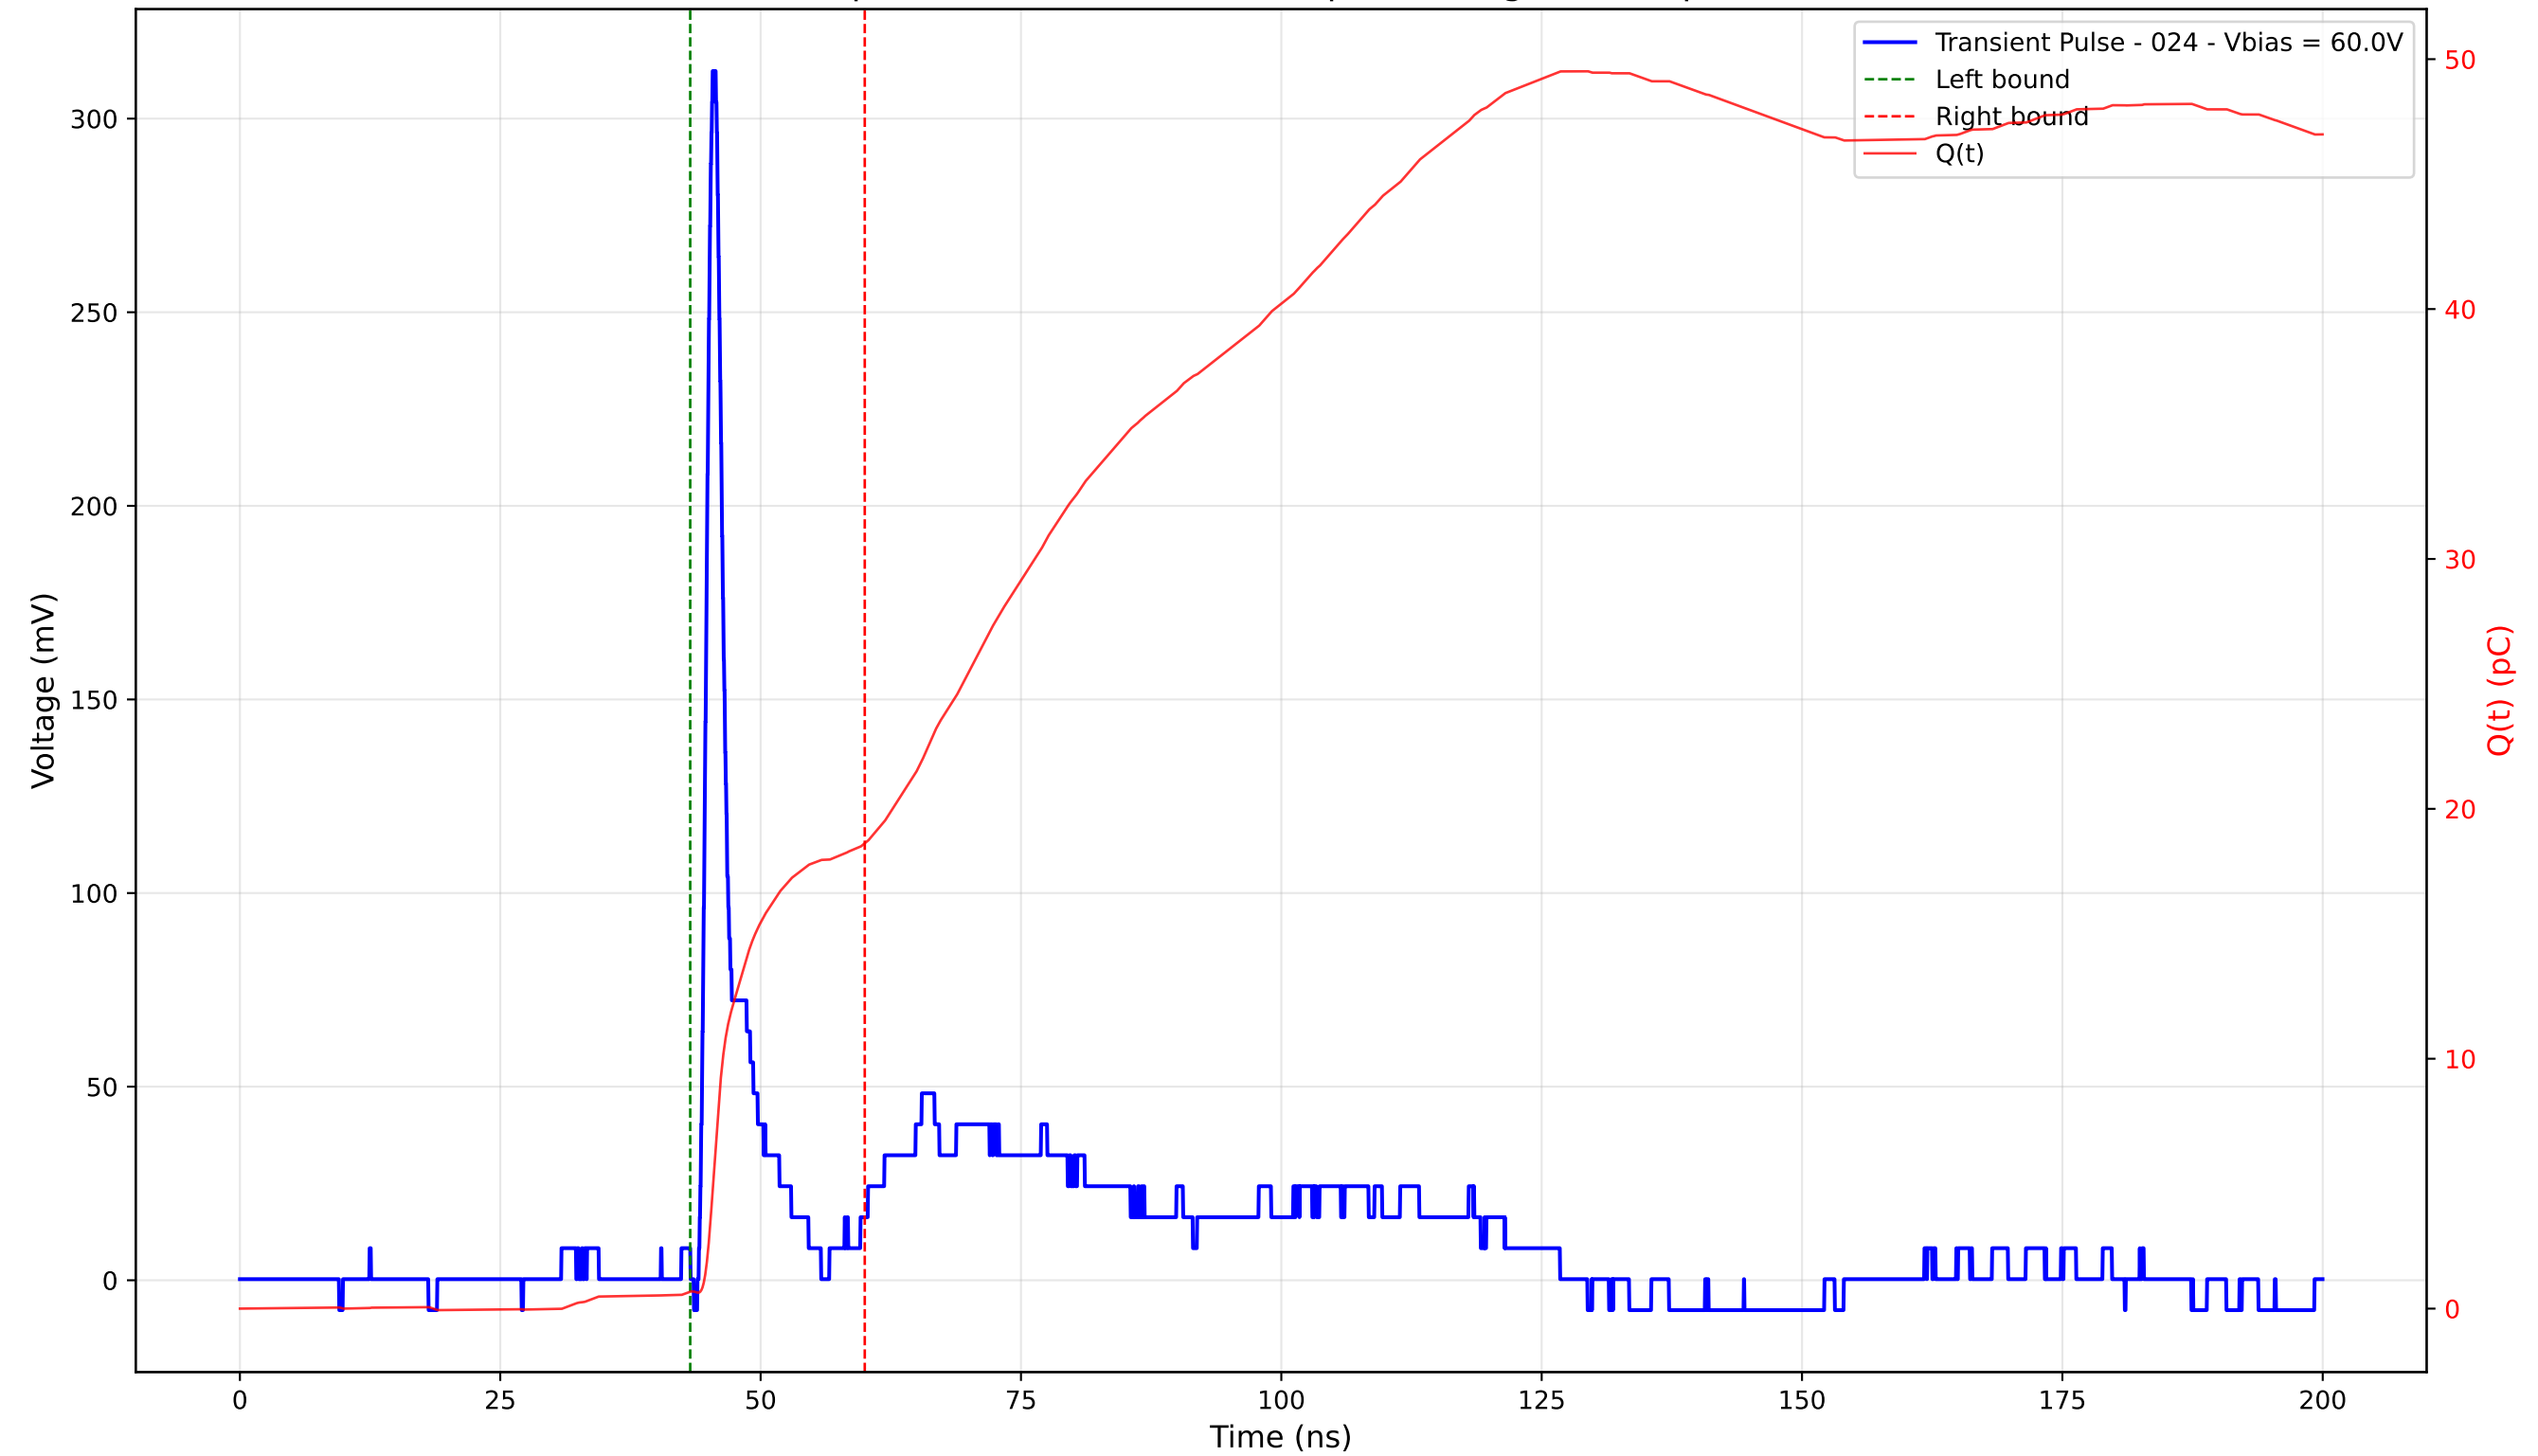


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 19.26 pC - Rise Time: 0.97 ns

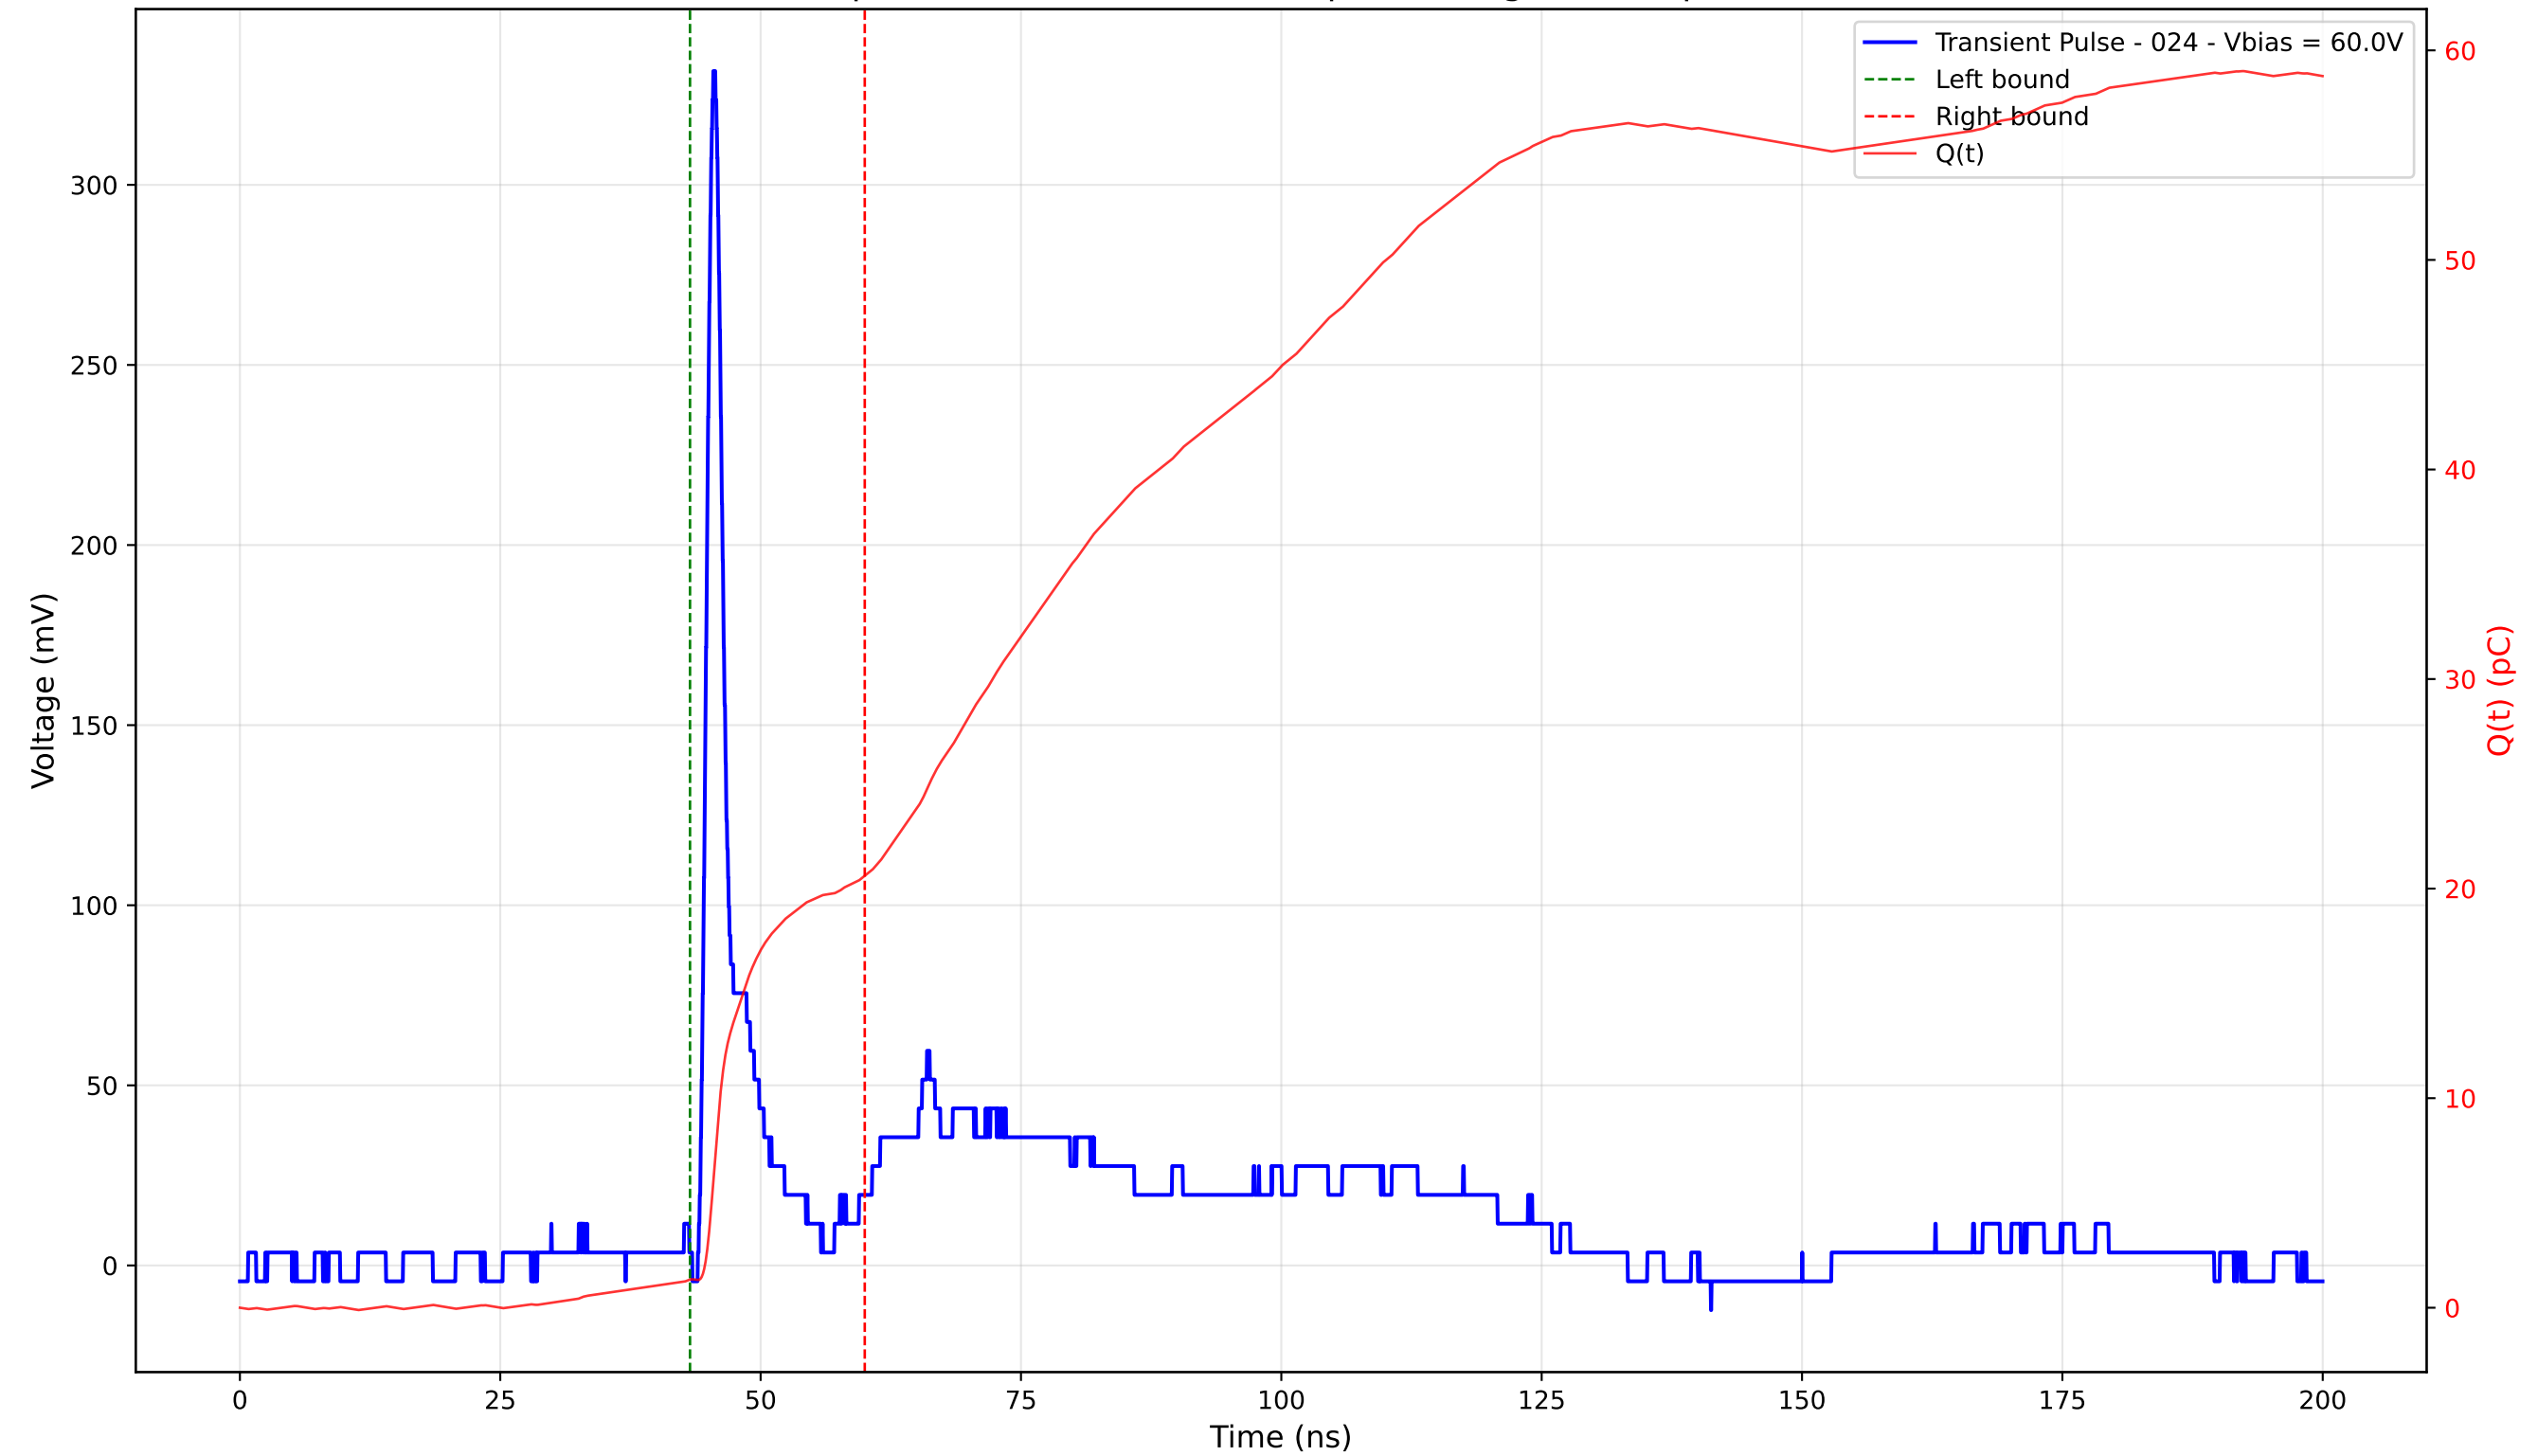


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 19.56 pC - Rise Time: 0.98 ns

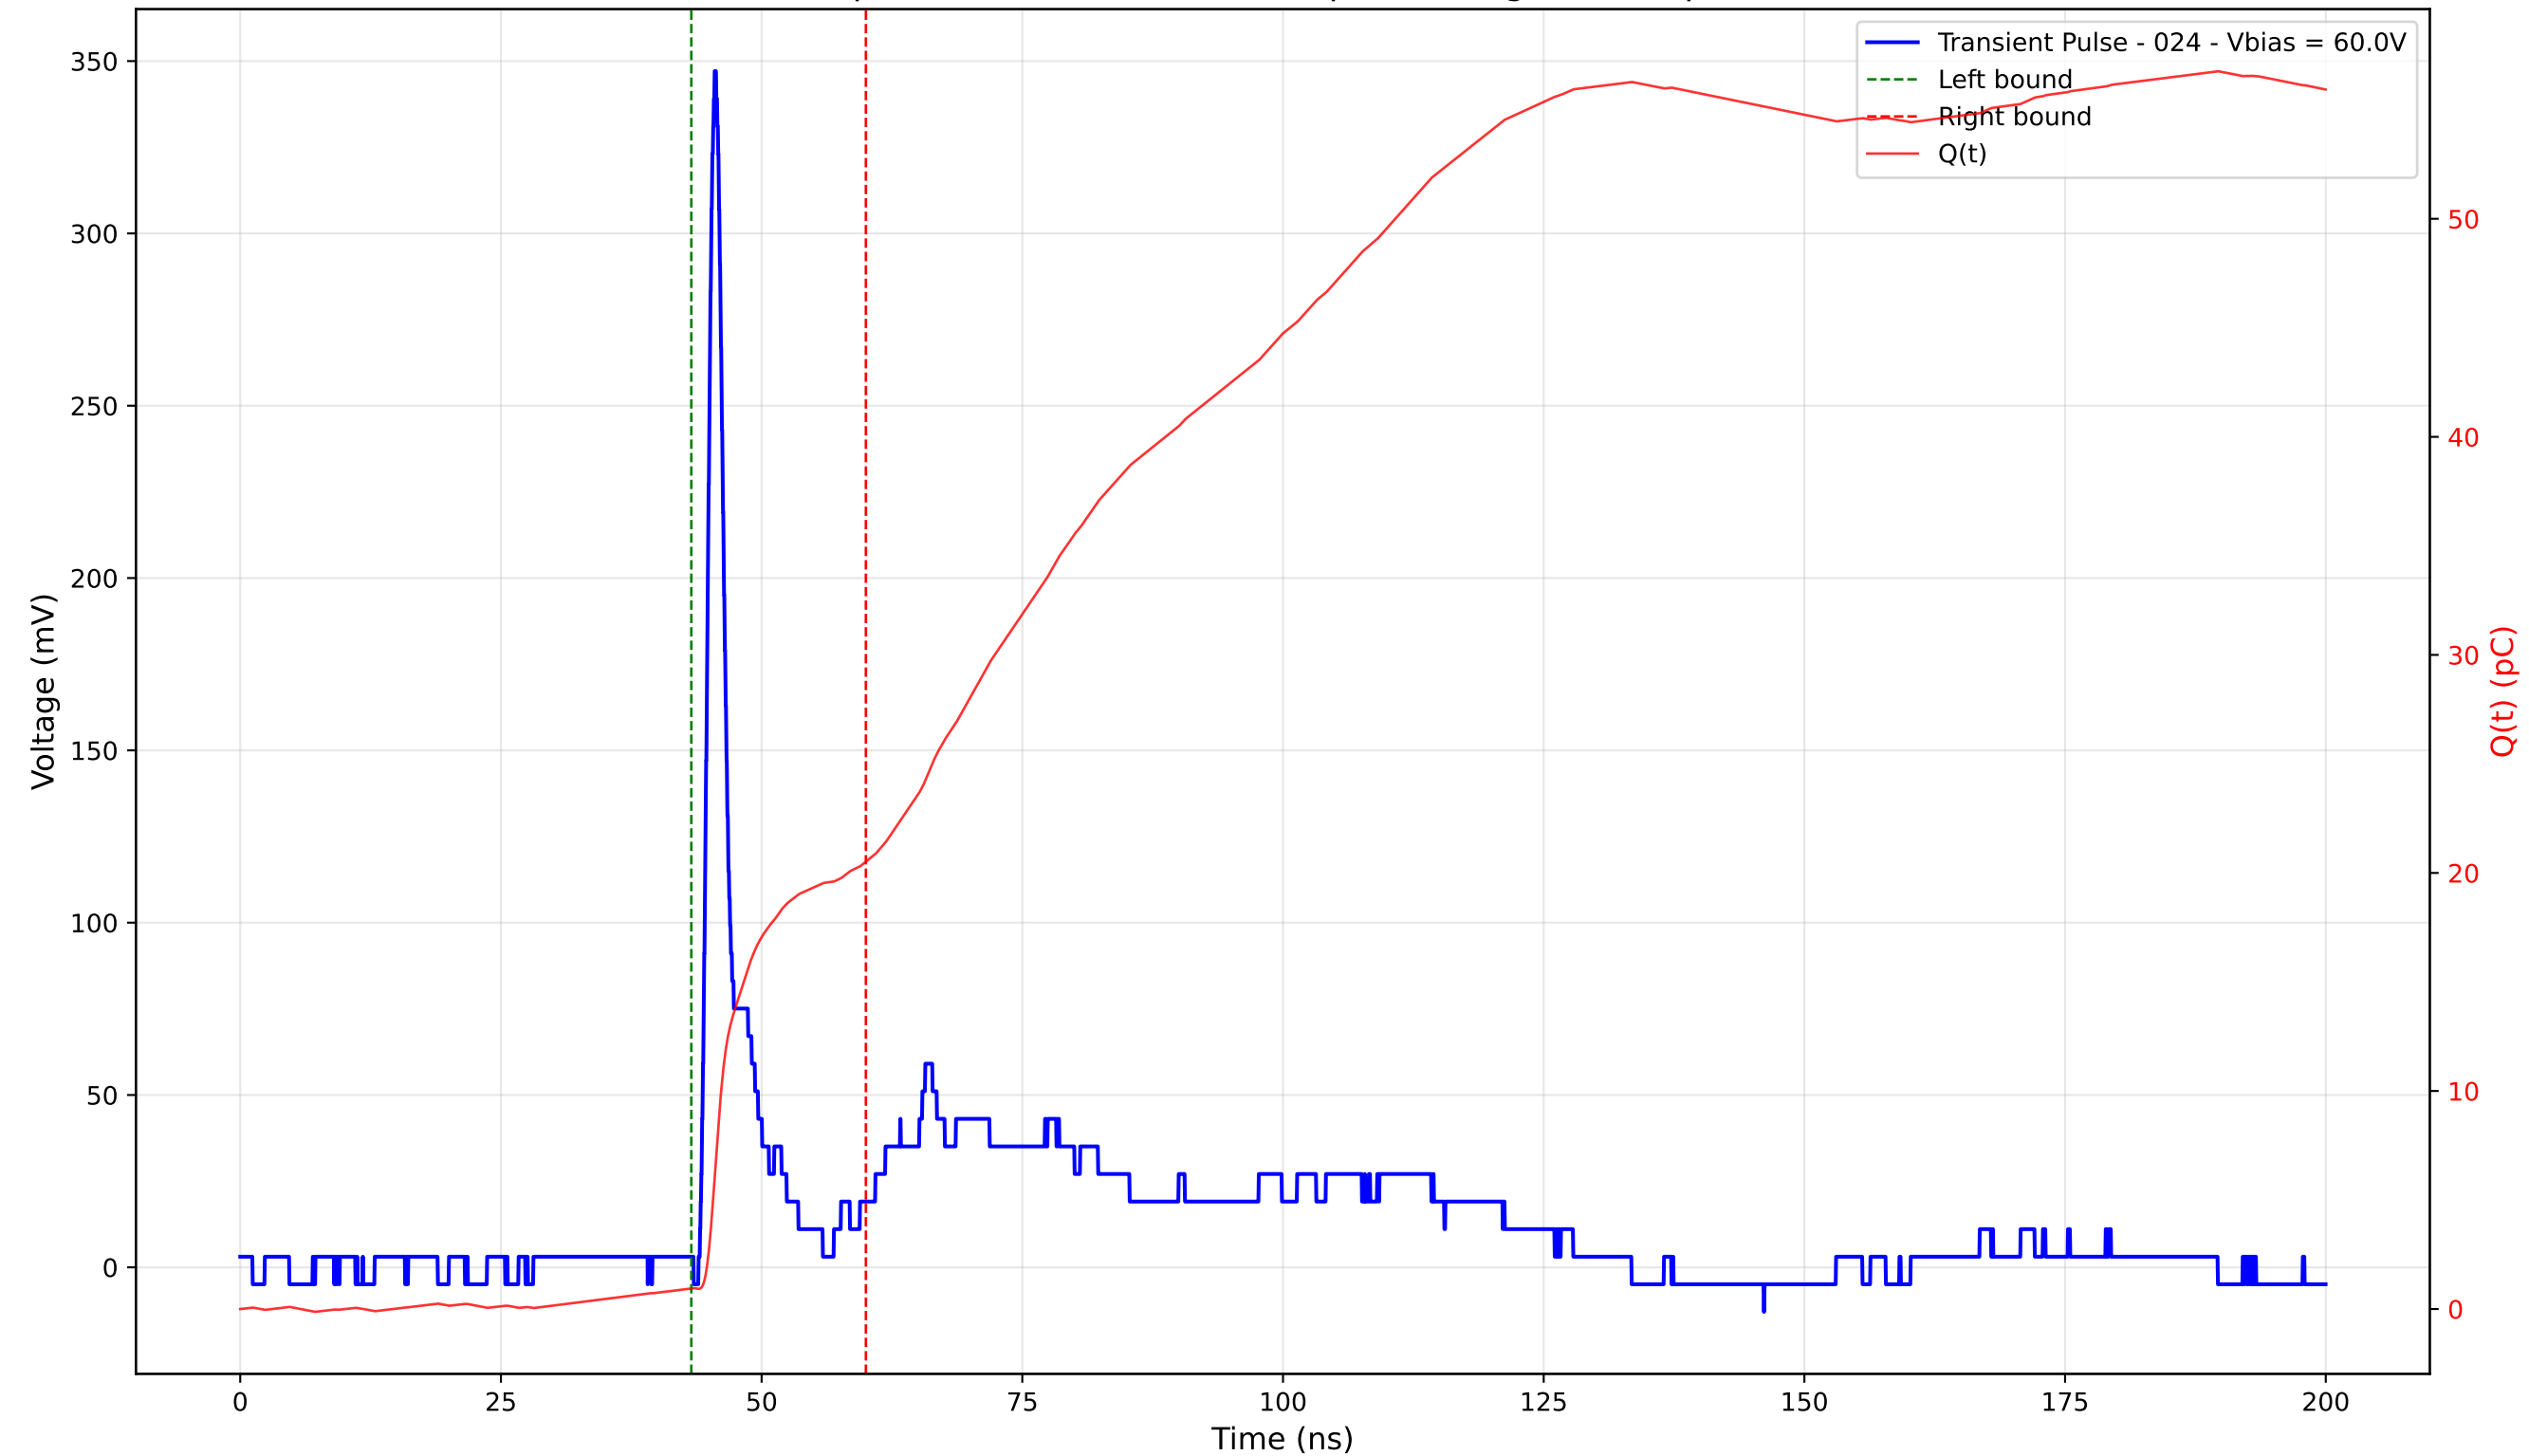


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 19.83 pC - Rise Time: 0.98 ns

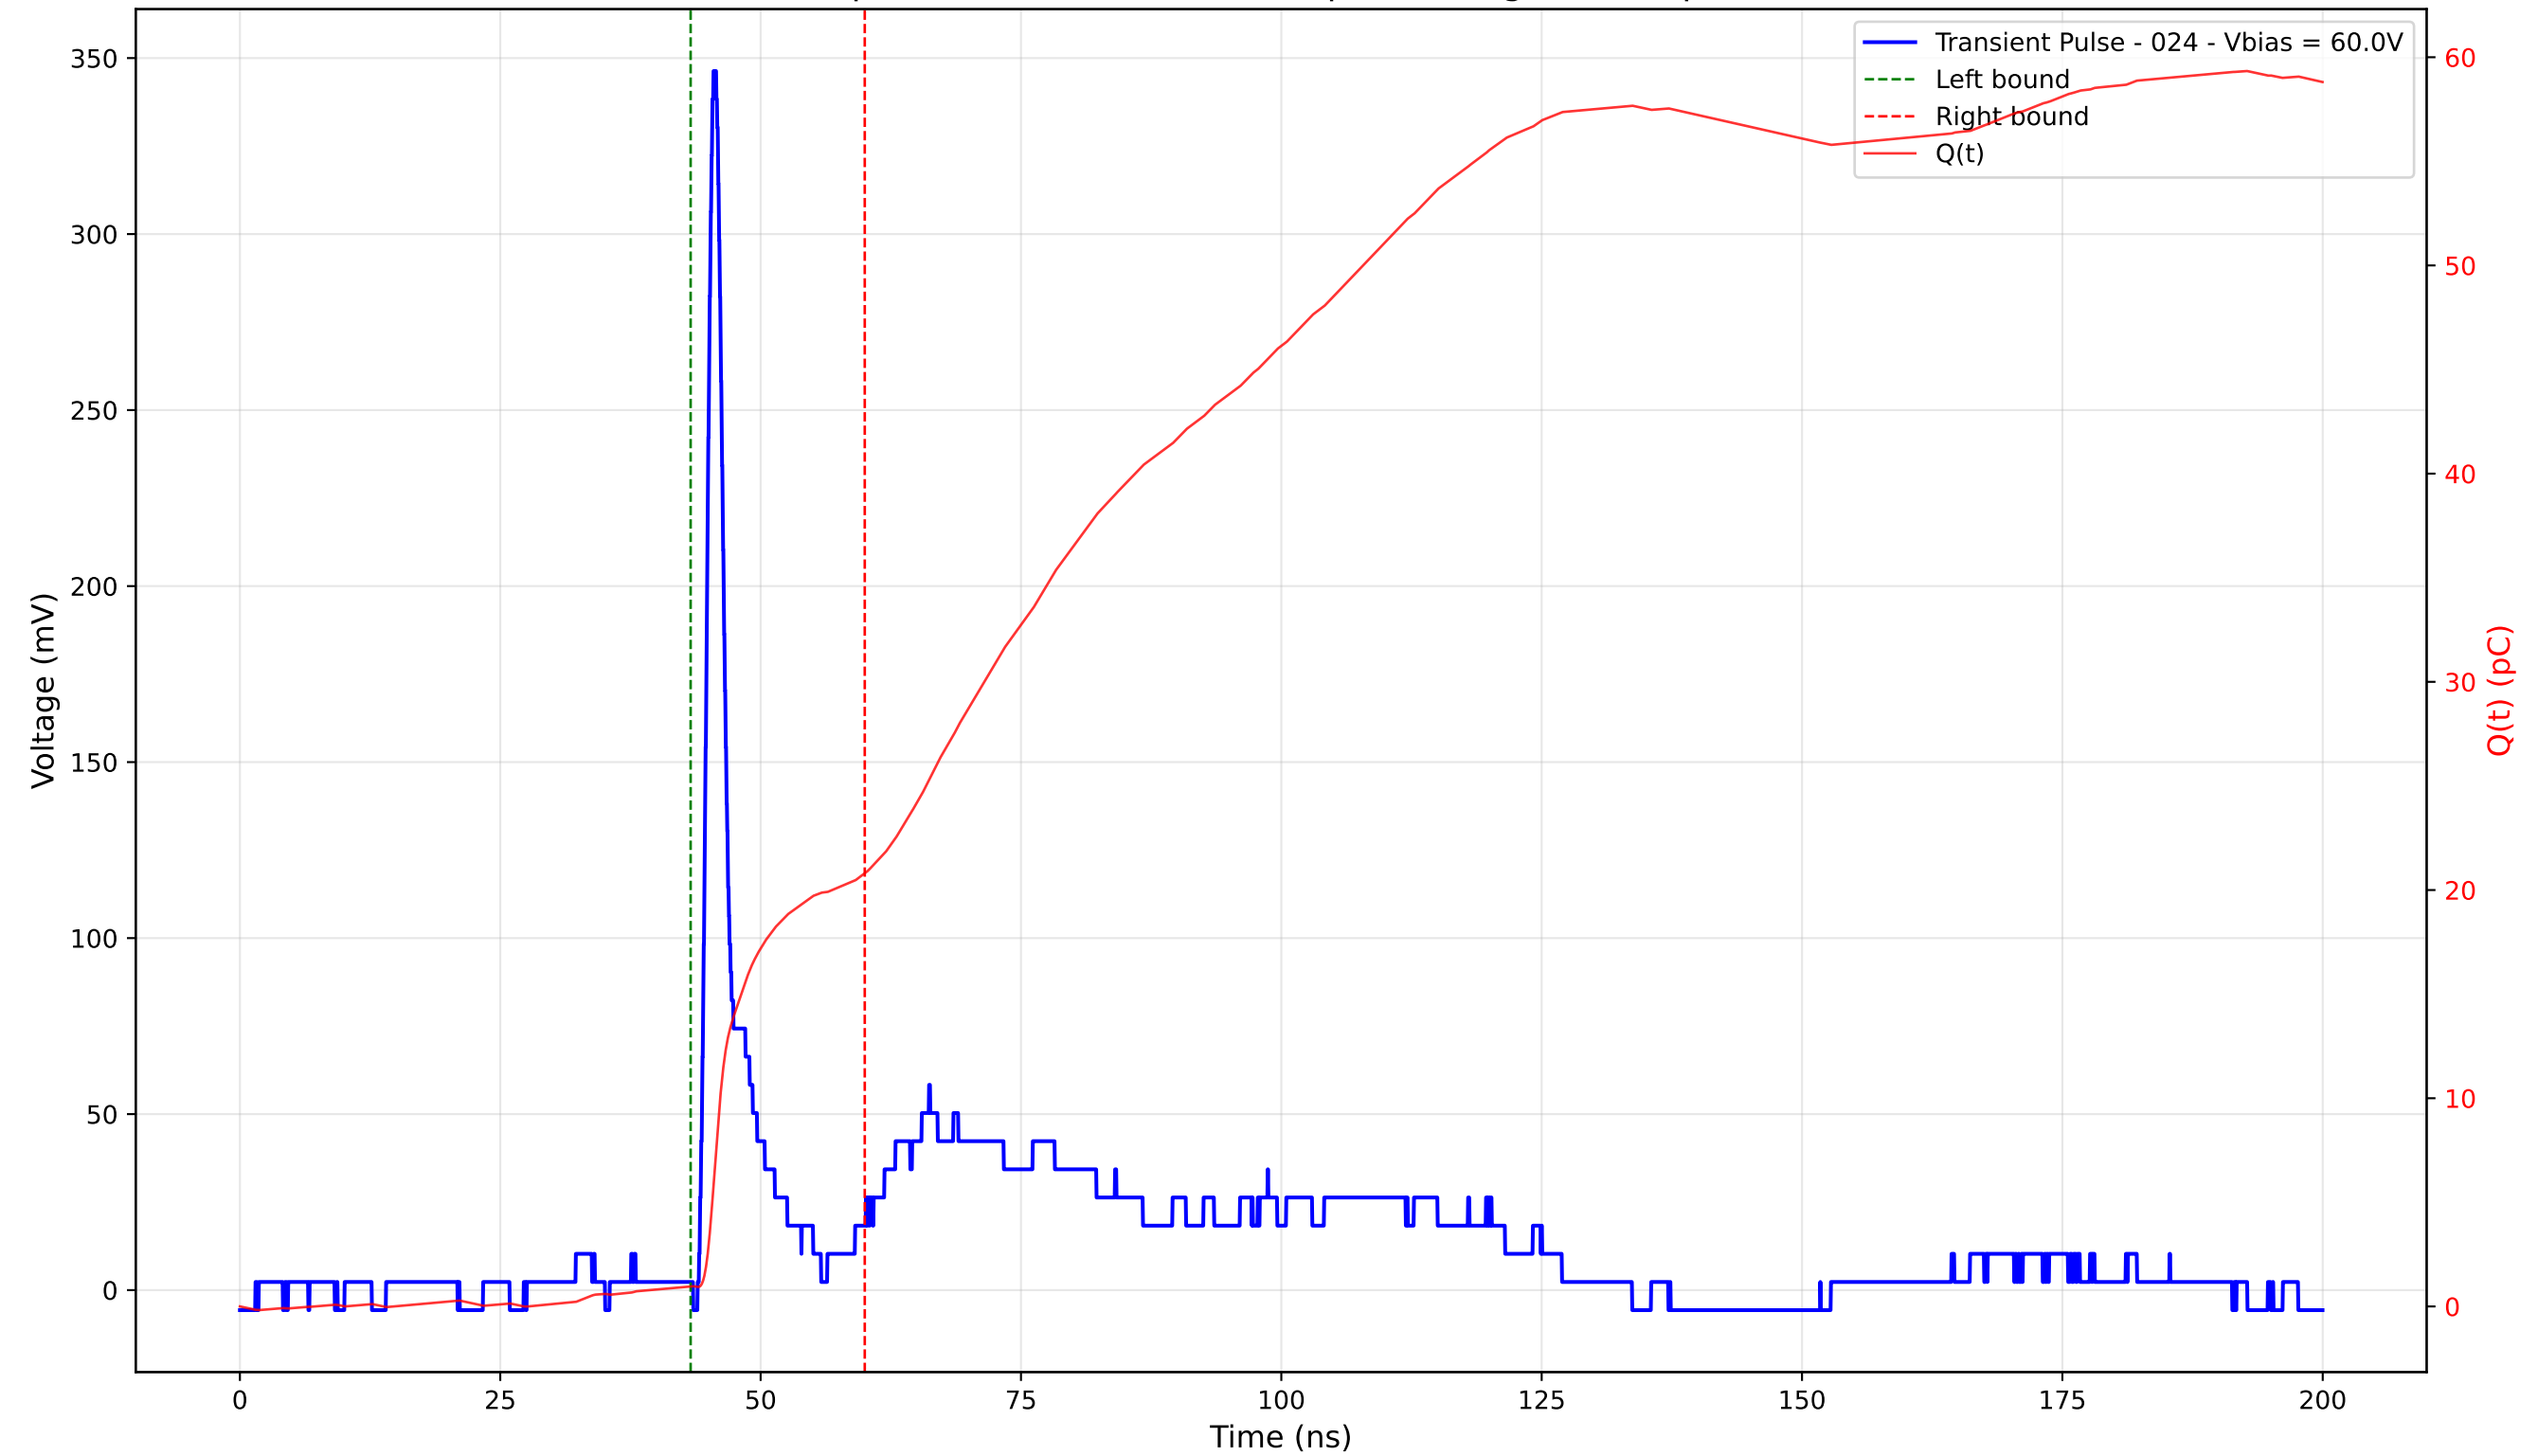


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 19.51 pC - Rise Time: 1.04 ns

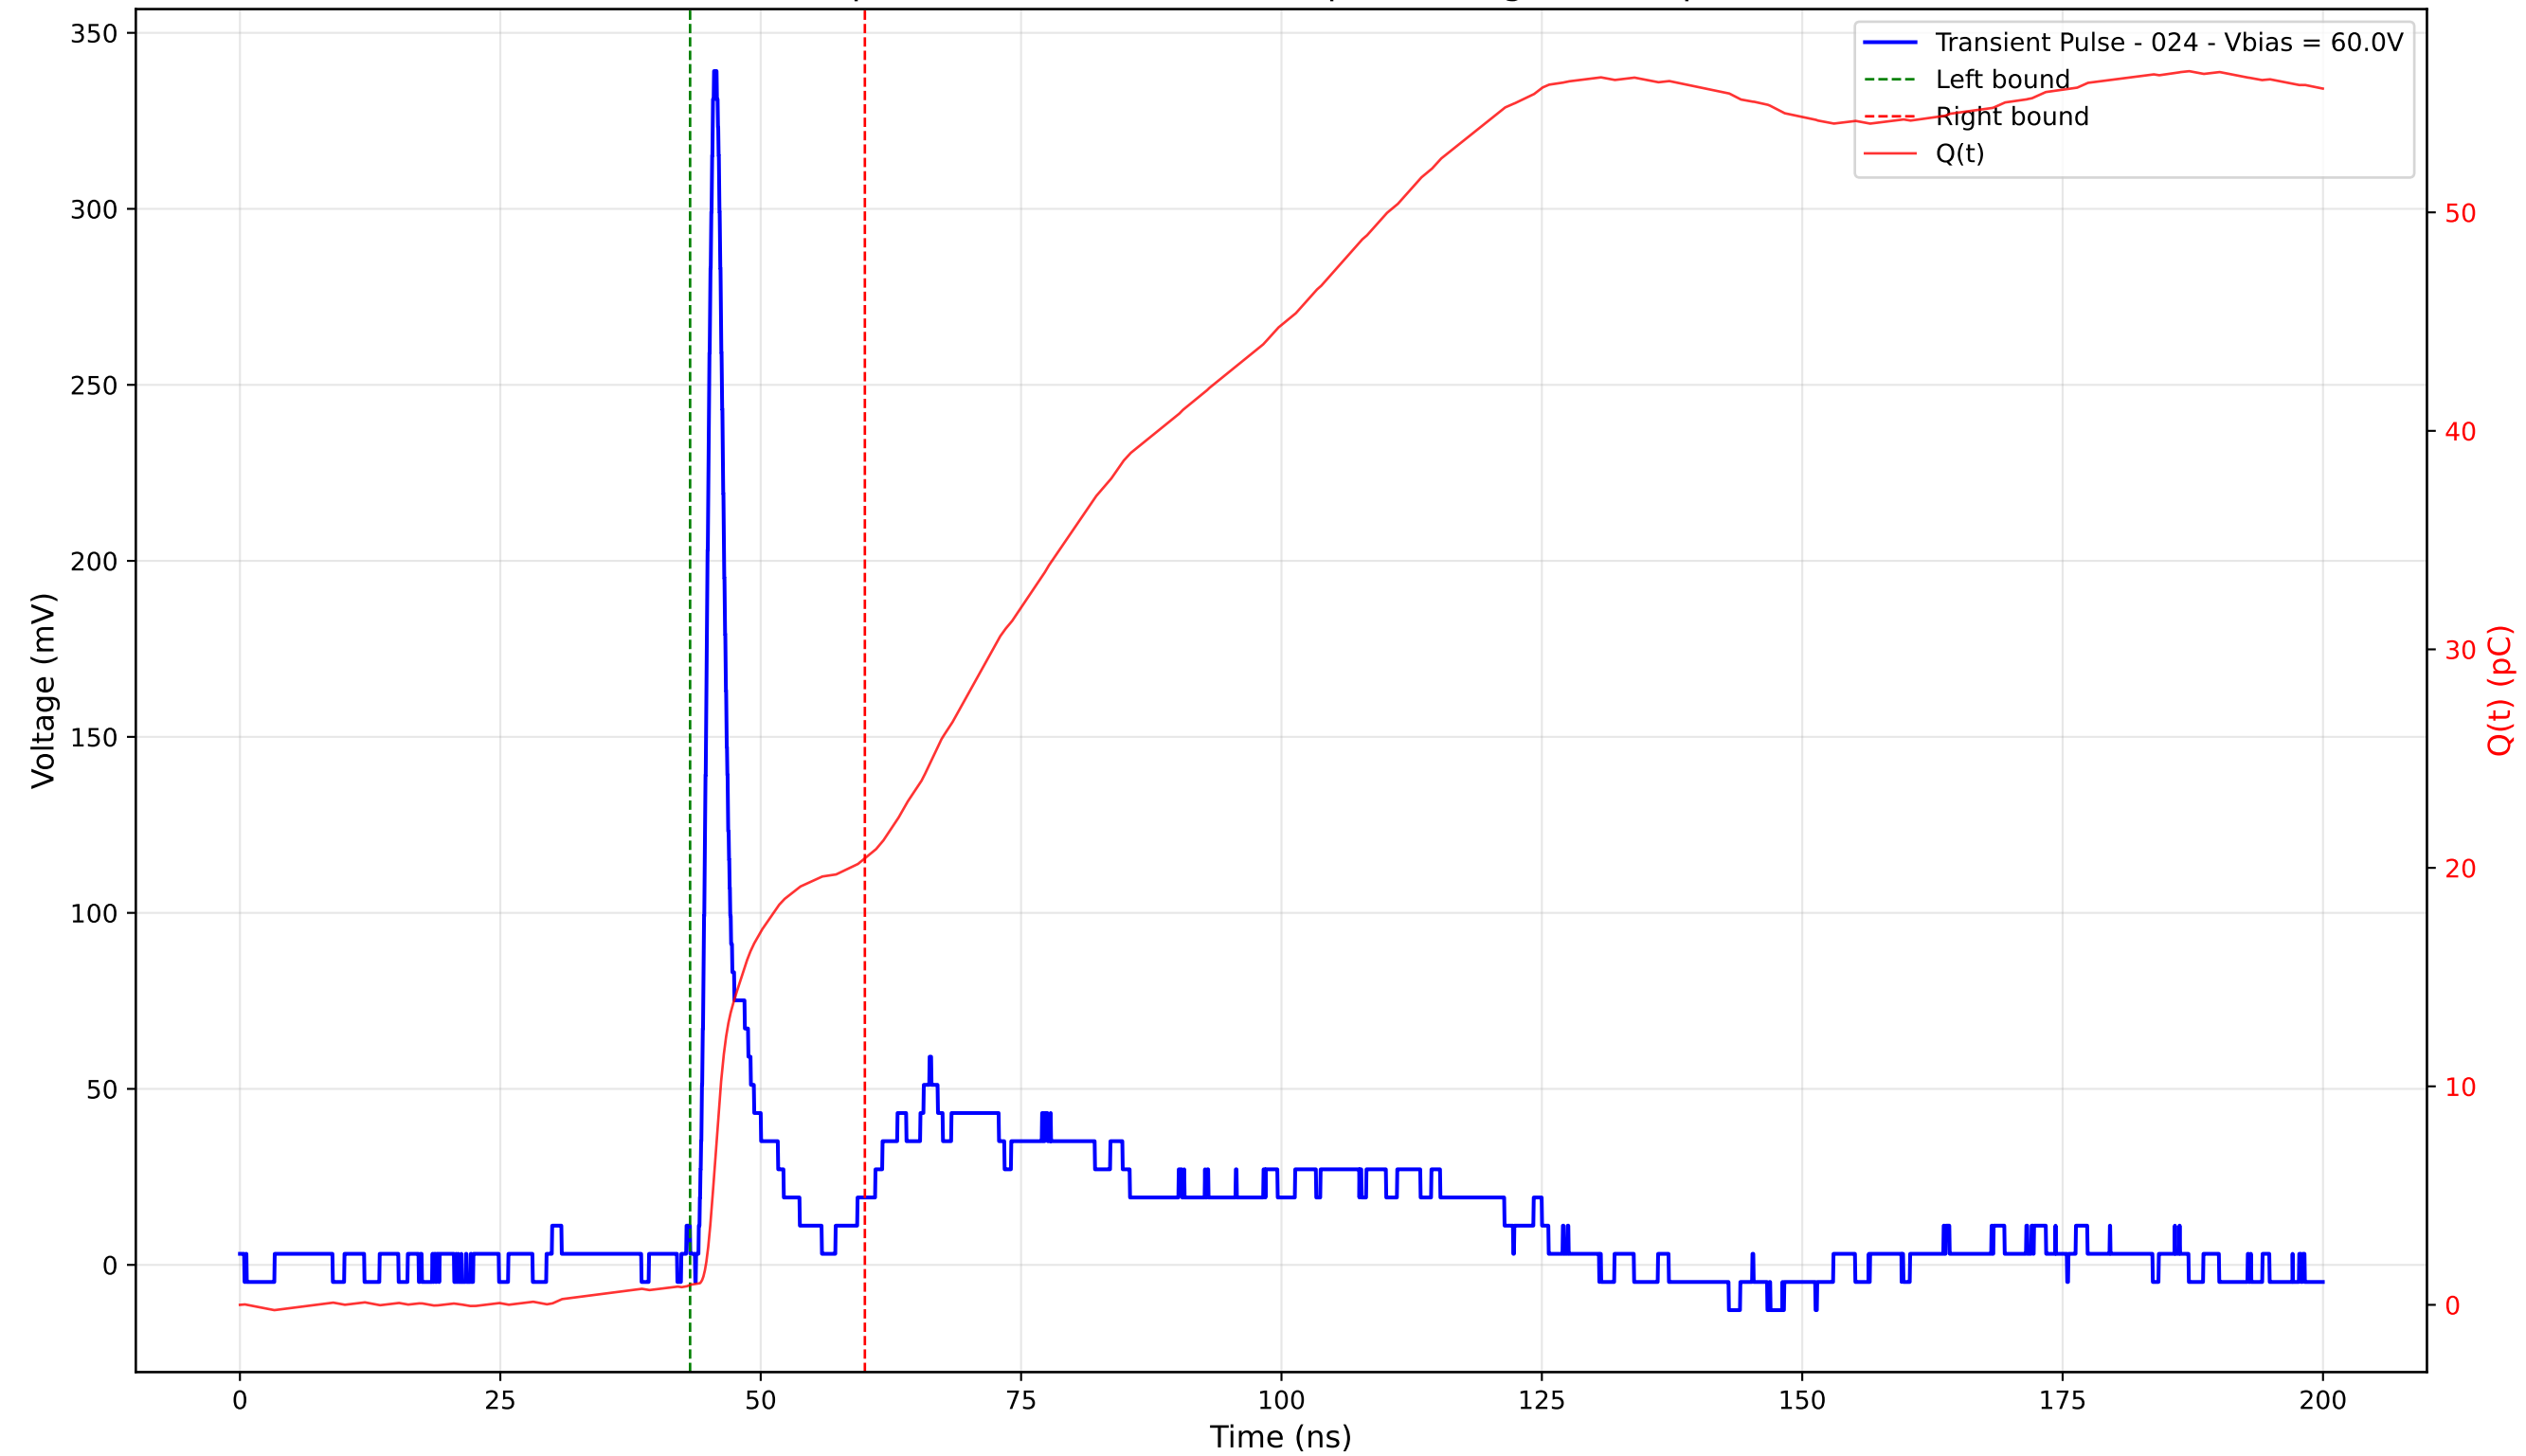


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 18.85 pC - Rise Time: 1.00 ns

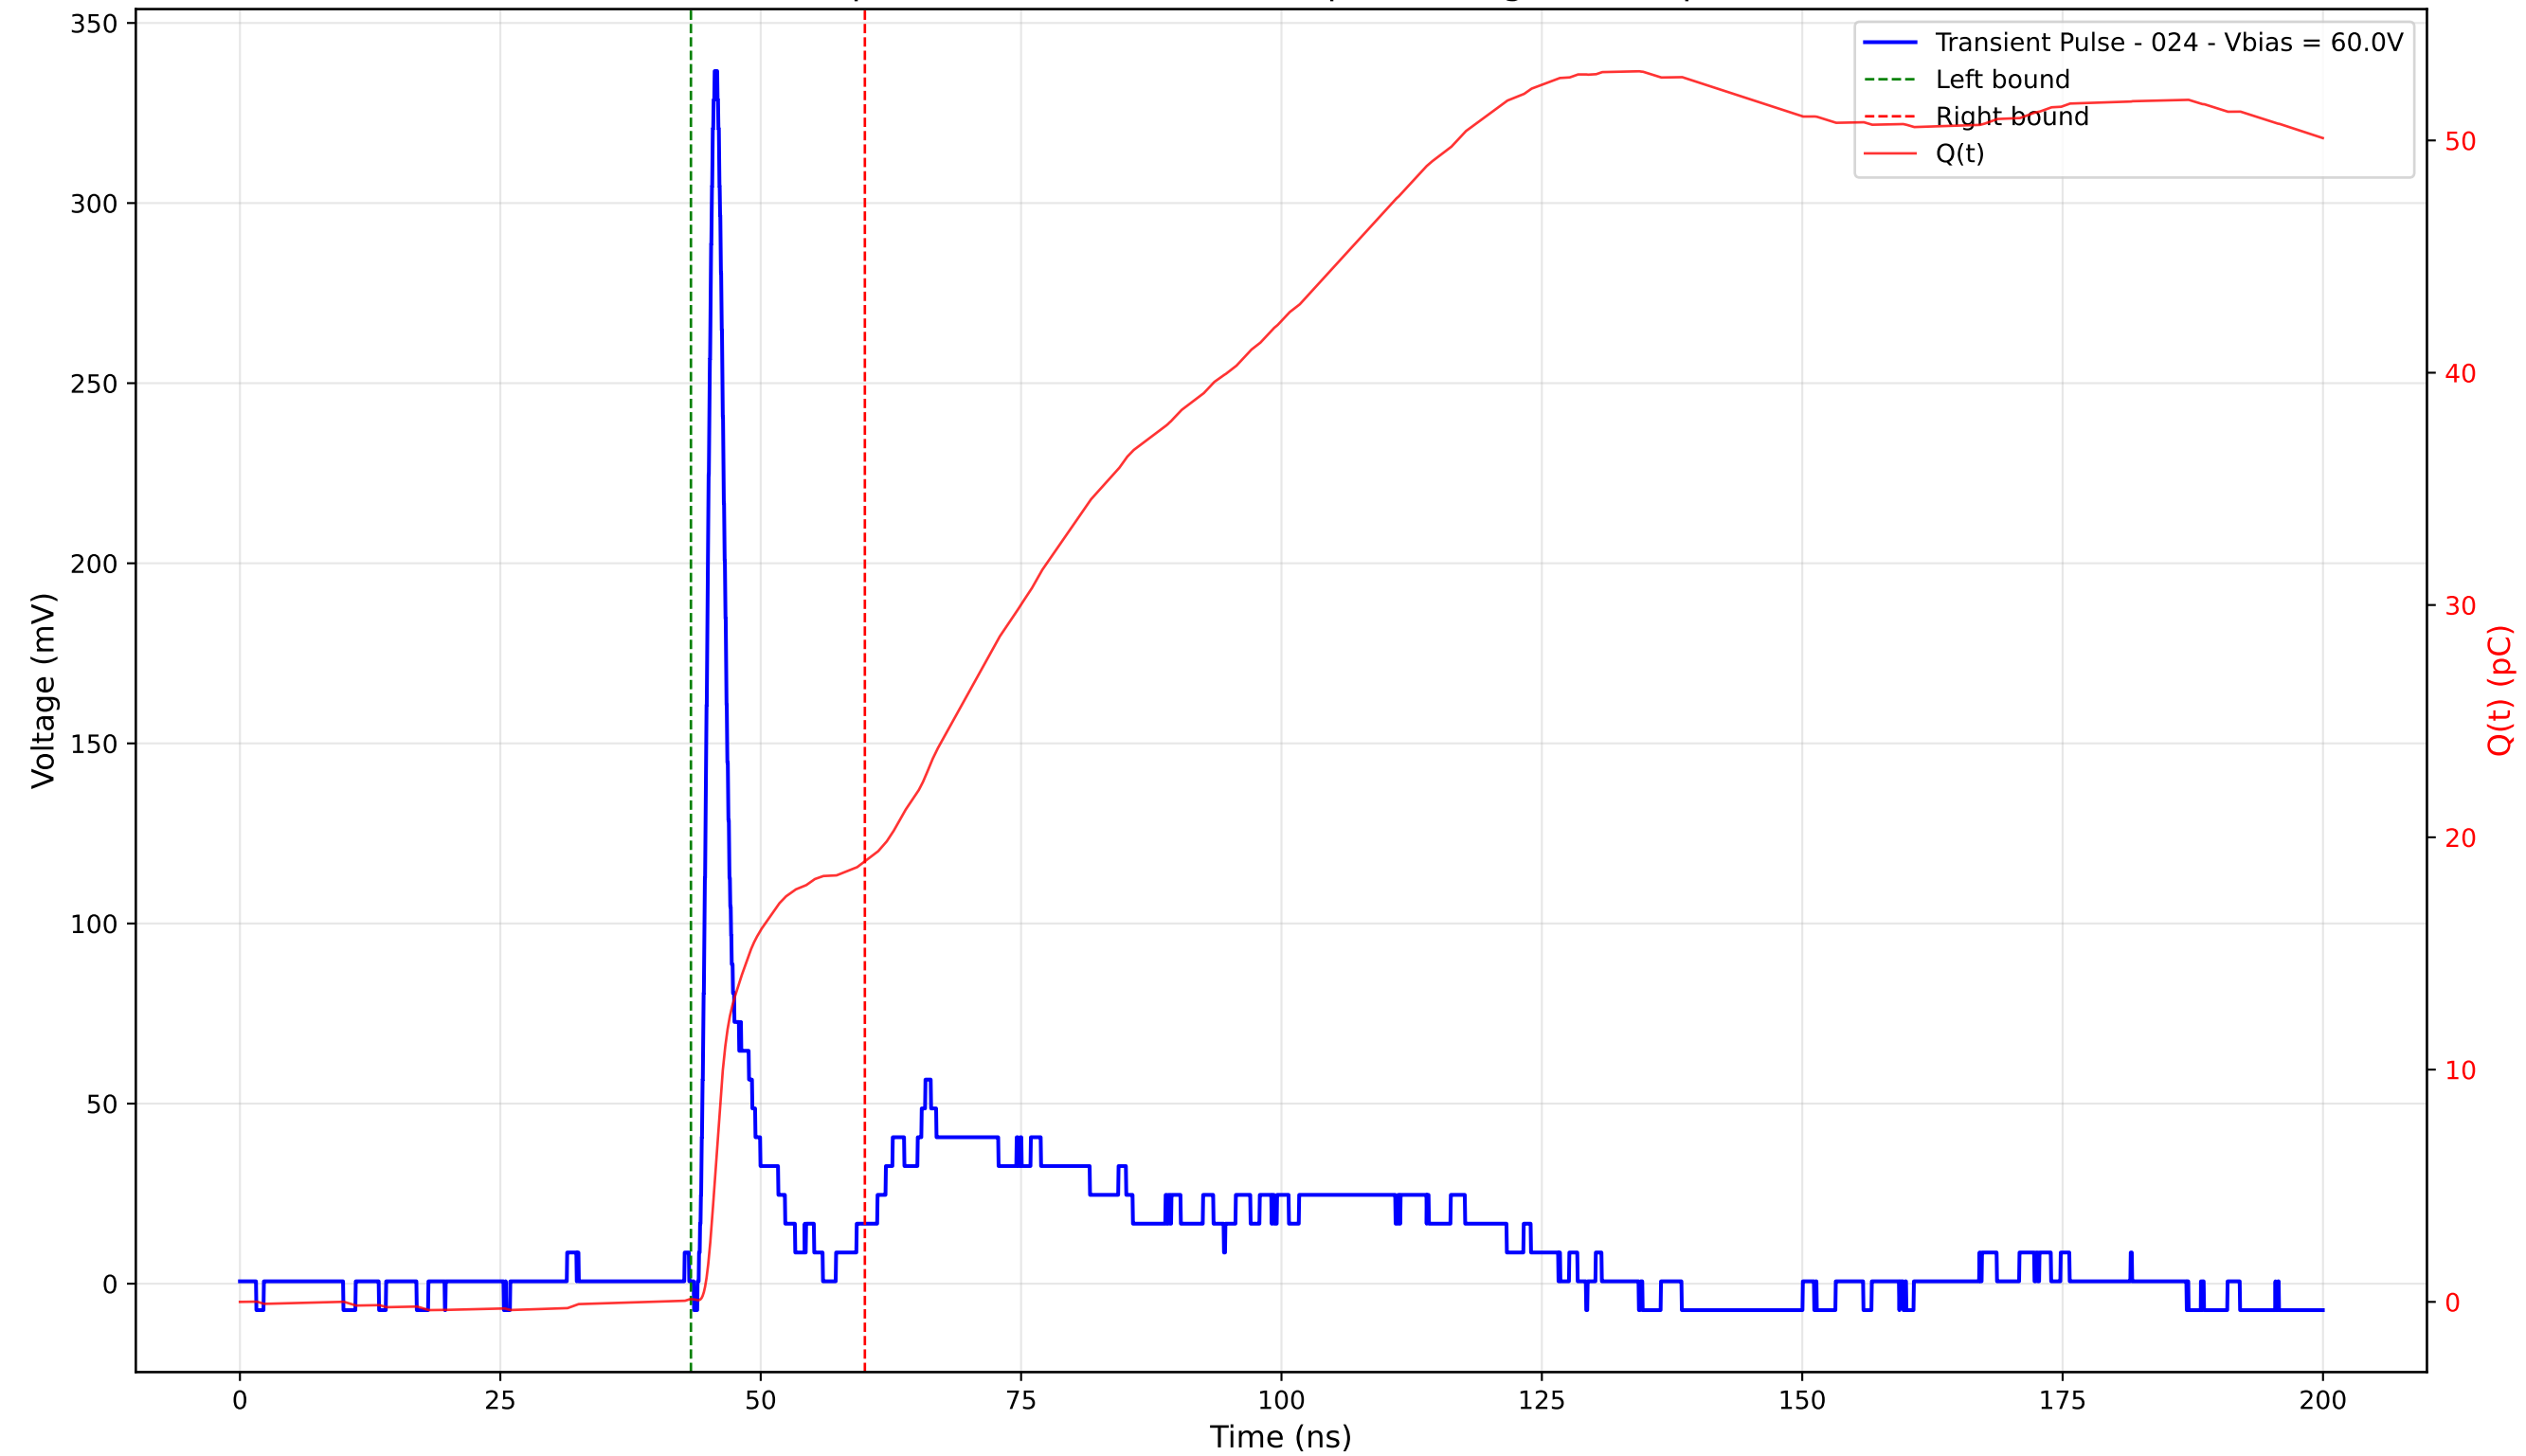


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 19.27 pC - Rise Time: 1.05 ns

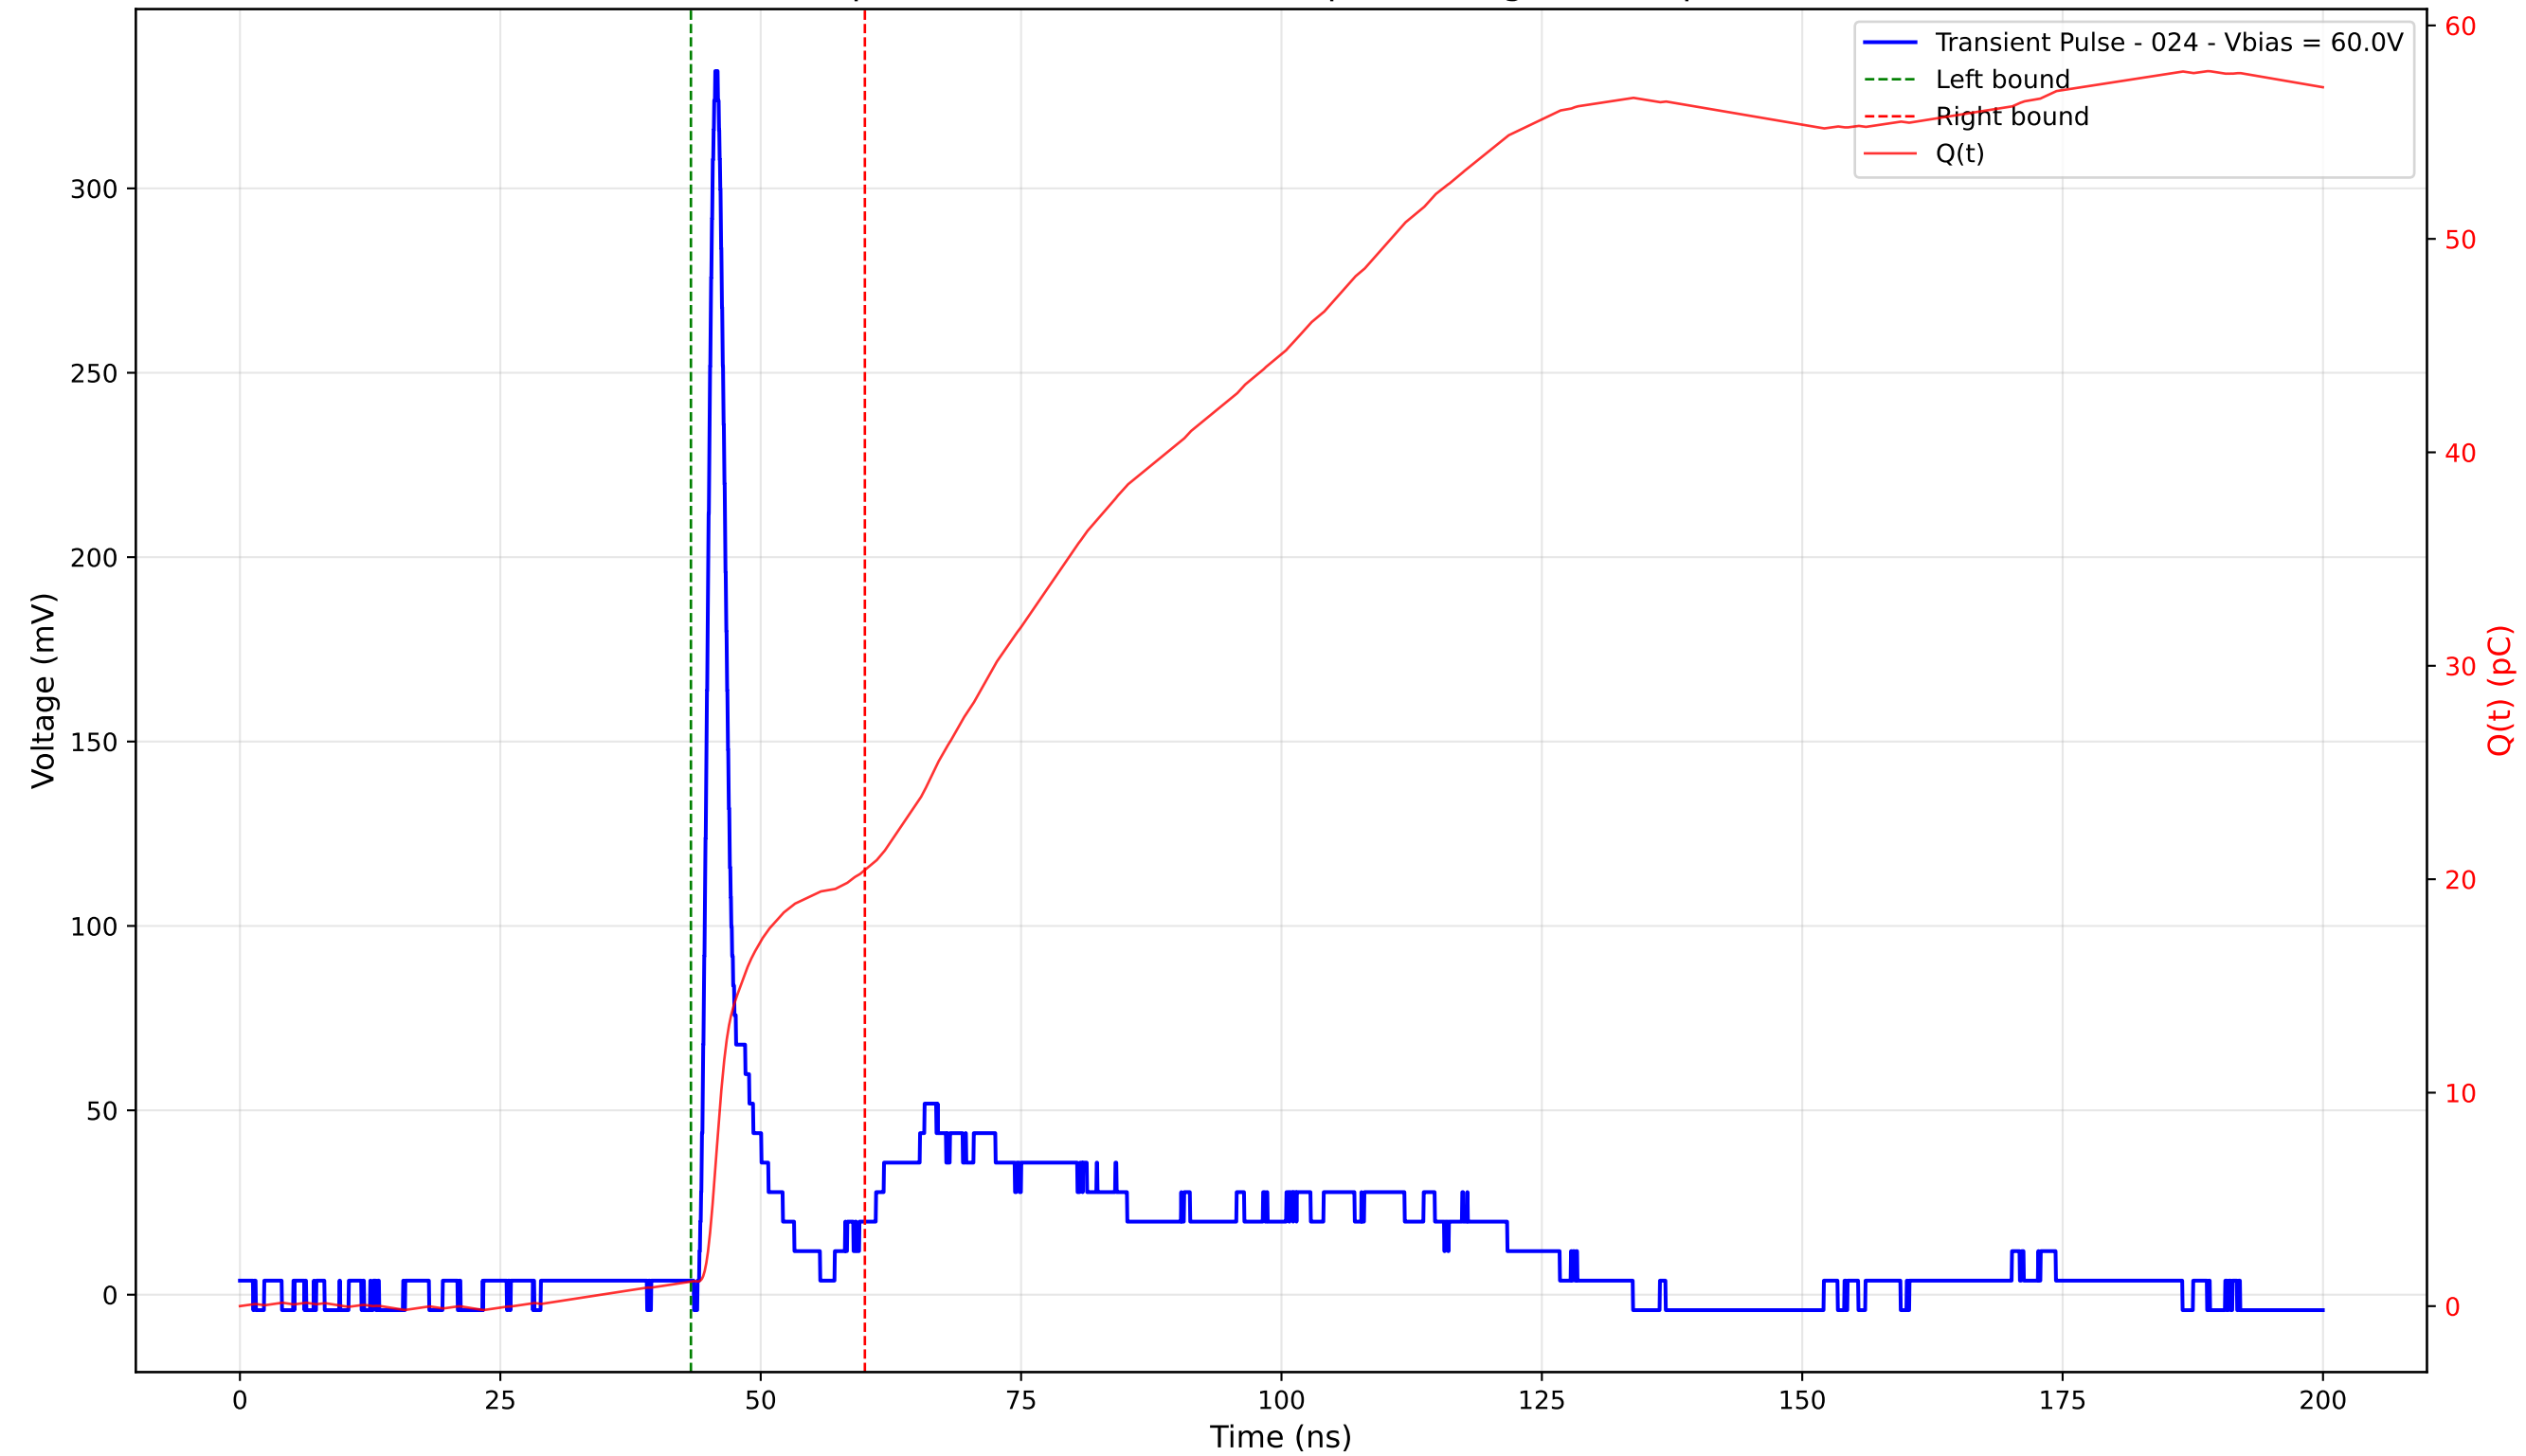


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 19.39 pC - Rise Time: 1.08 ns

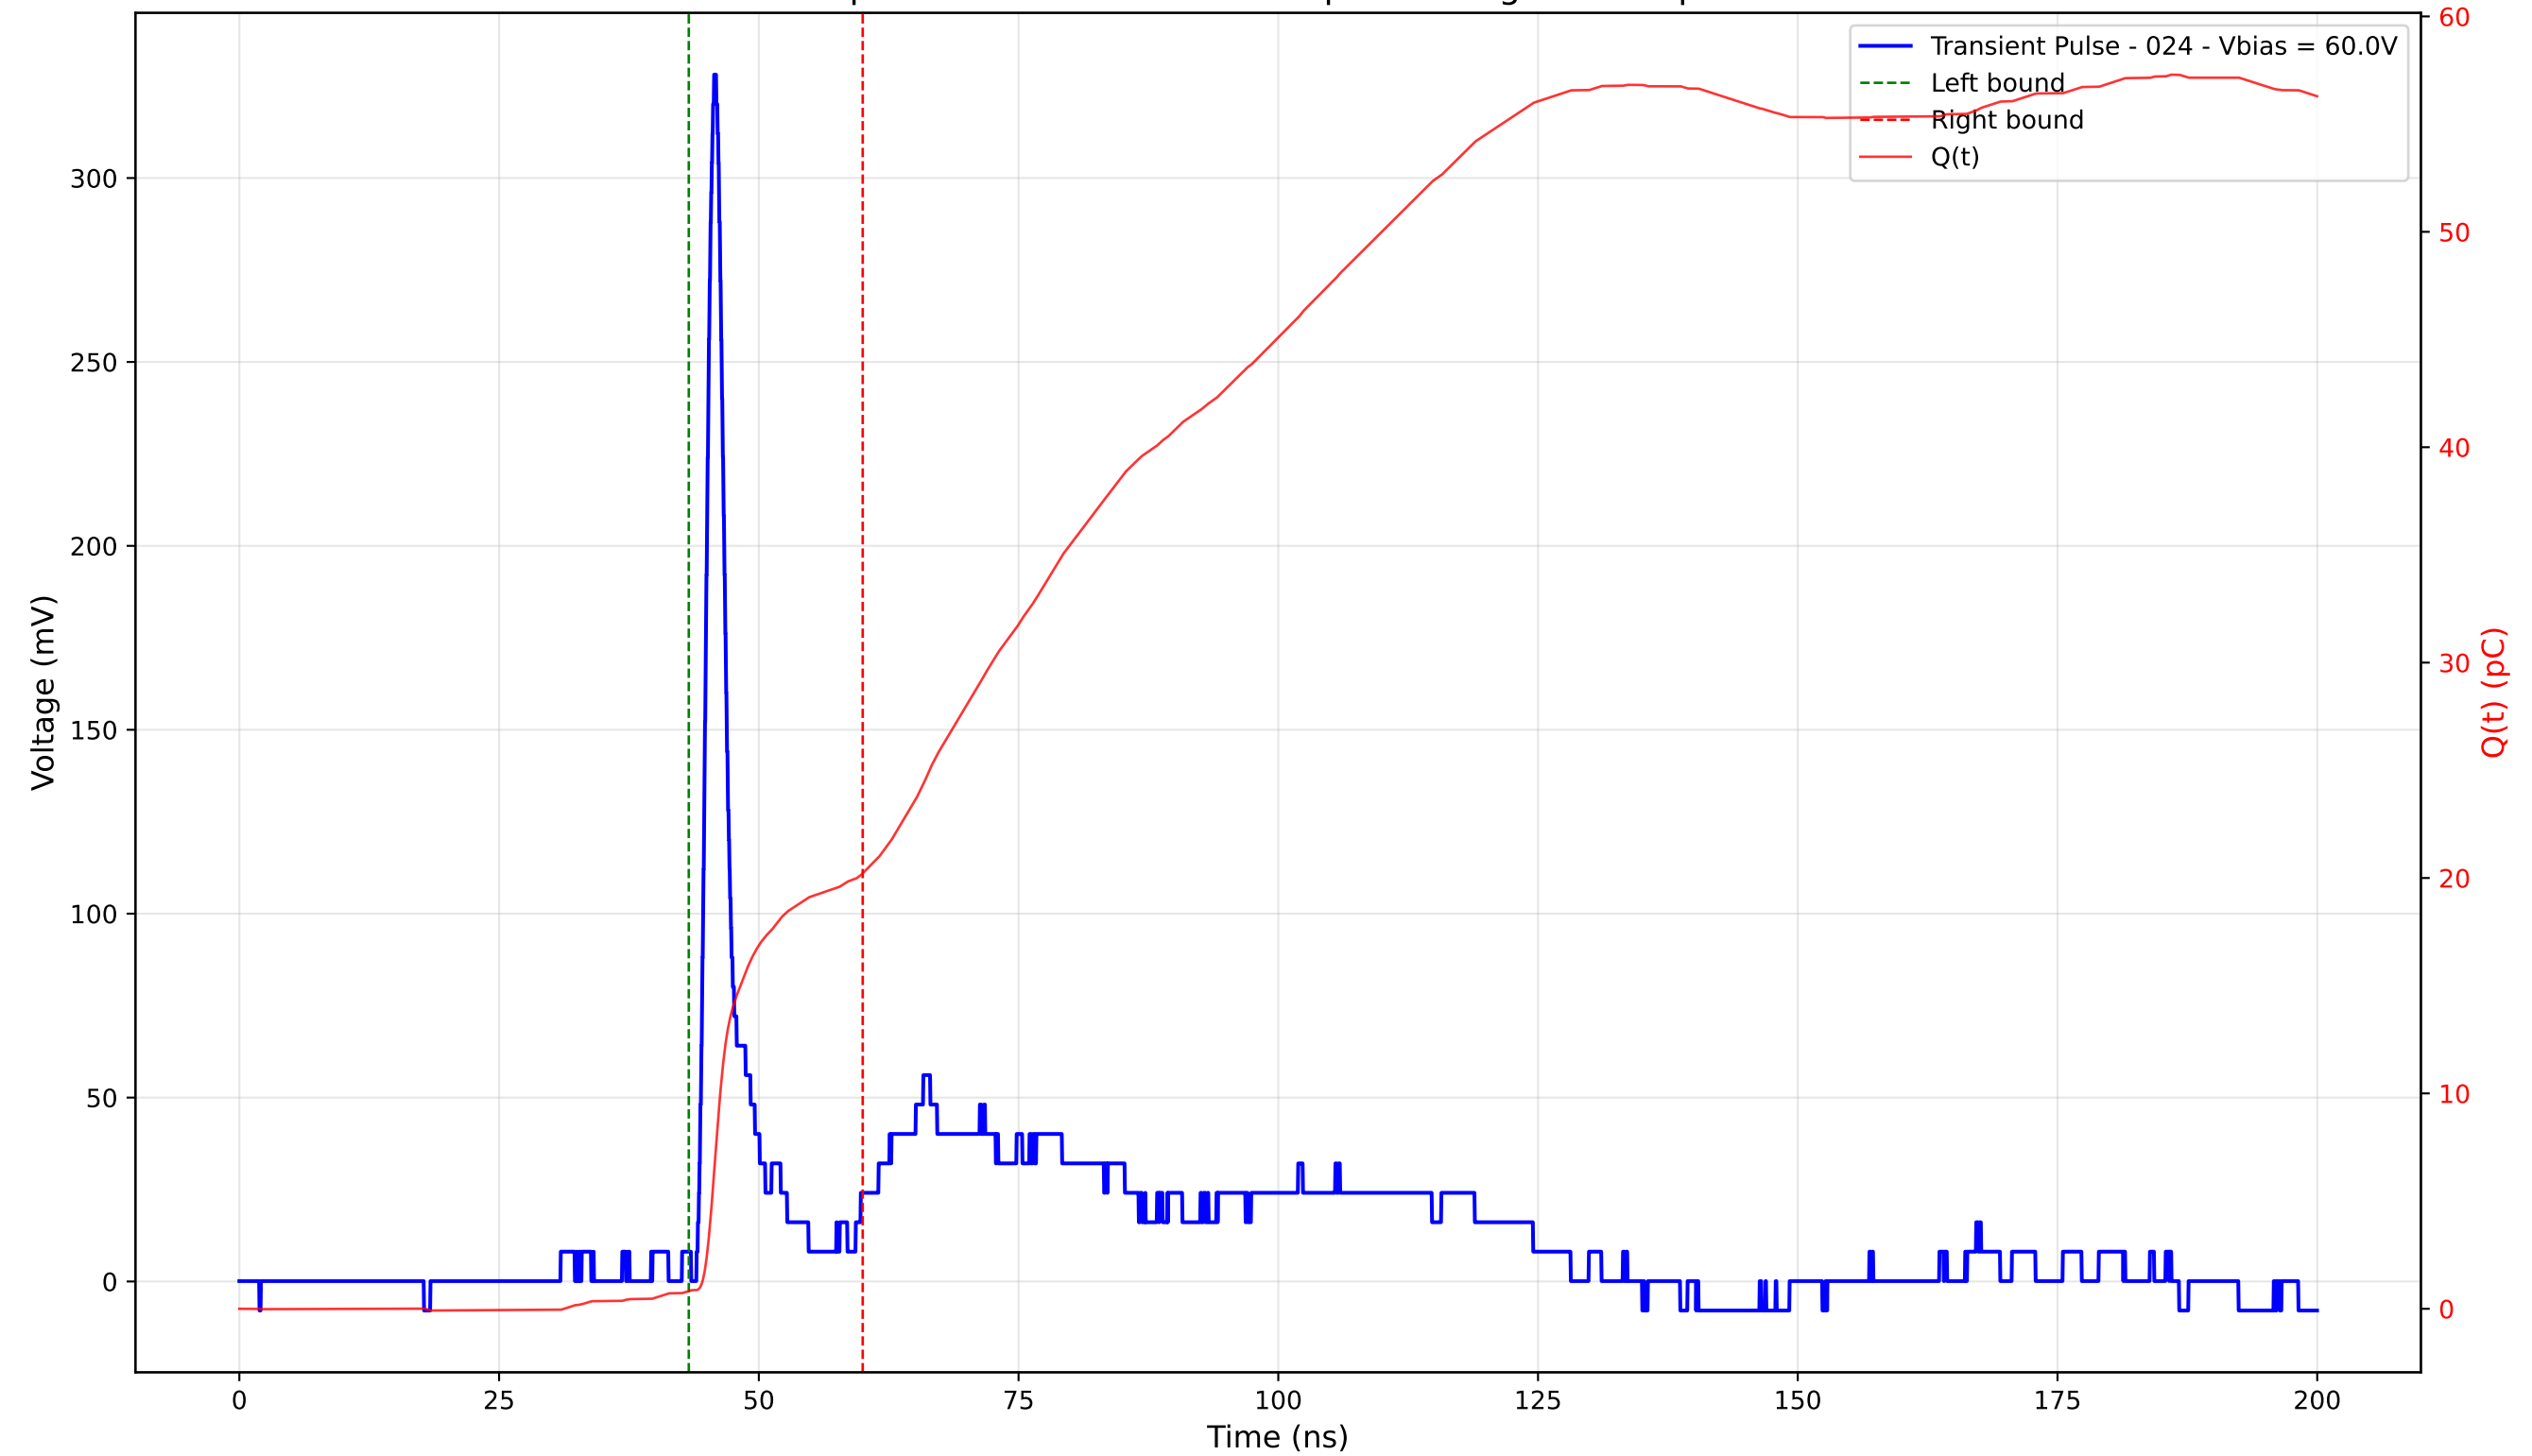


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 19.11 pC - Rise Time: 1.15 ns

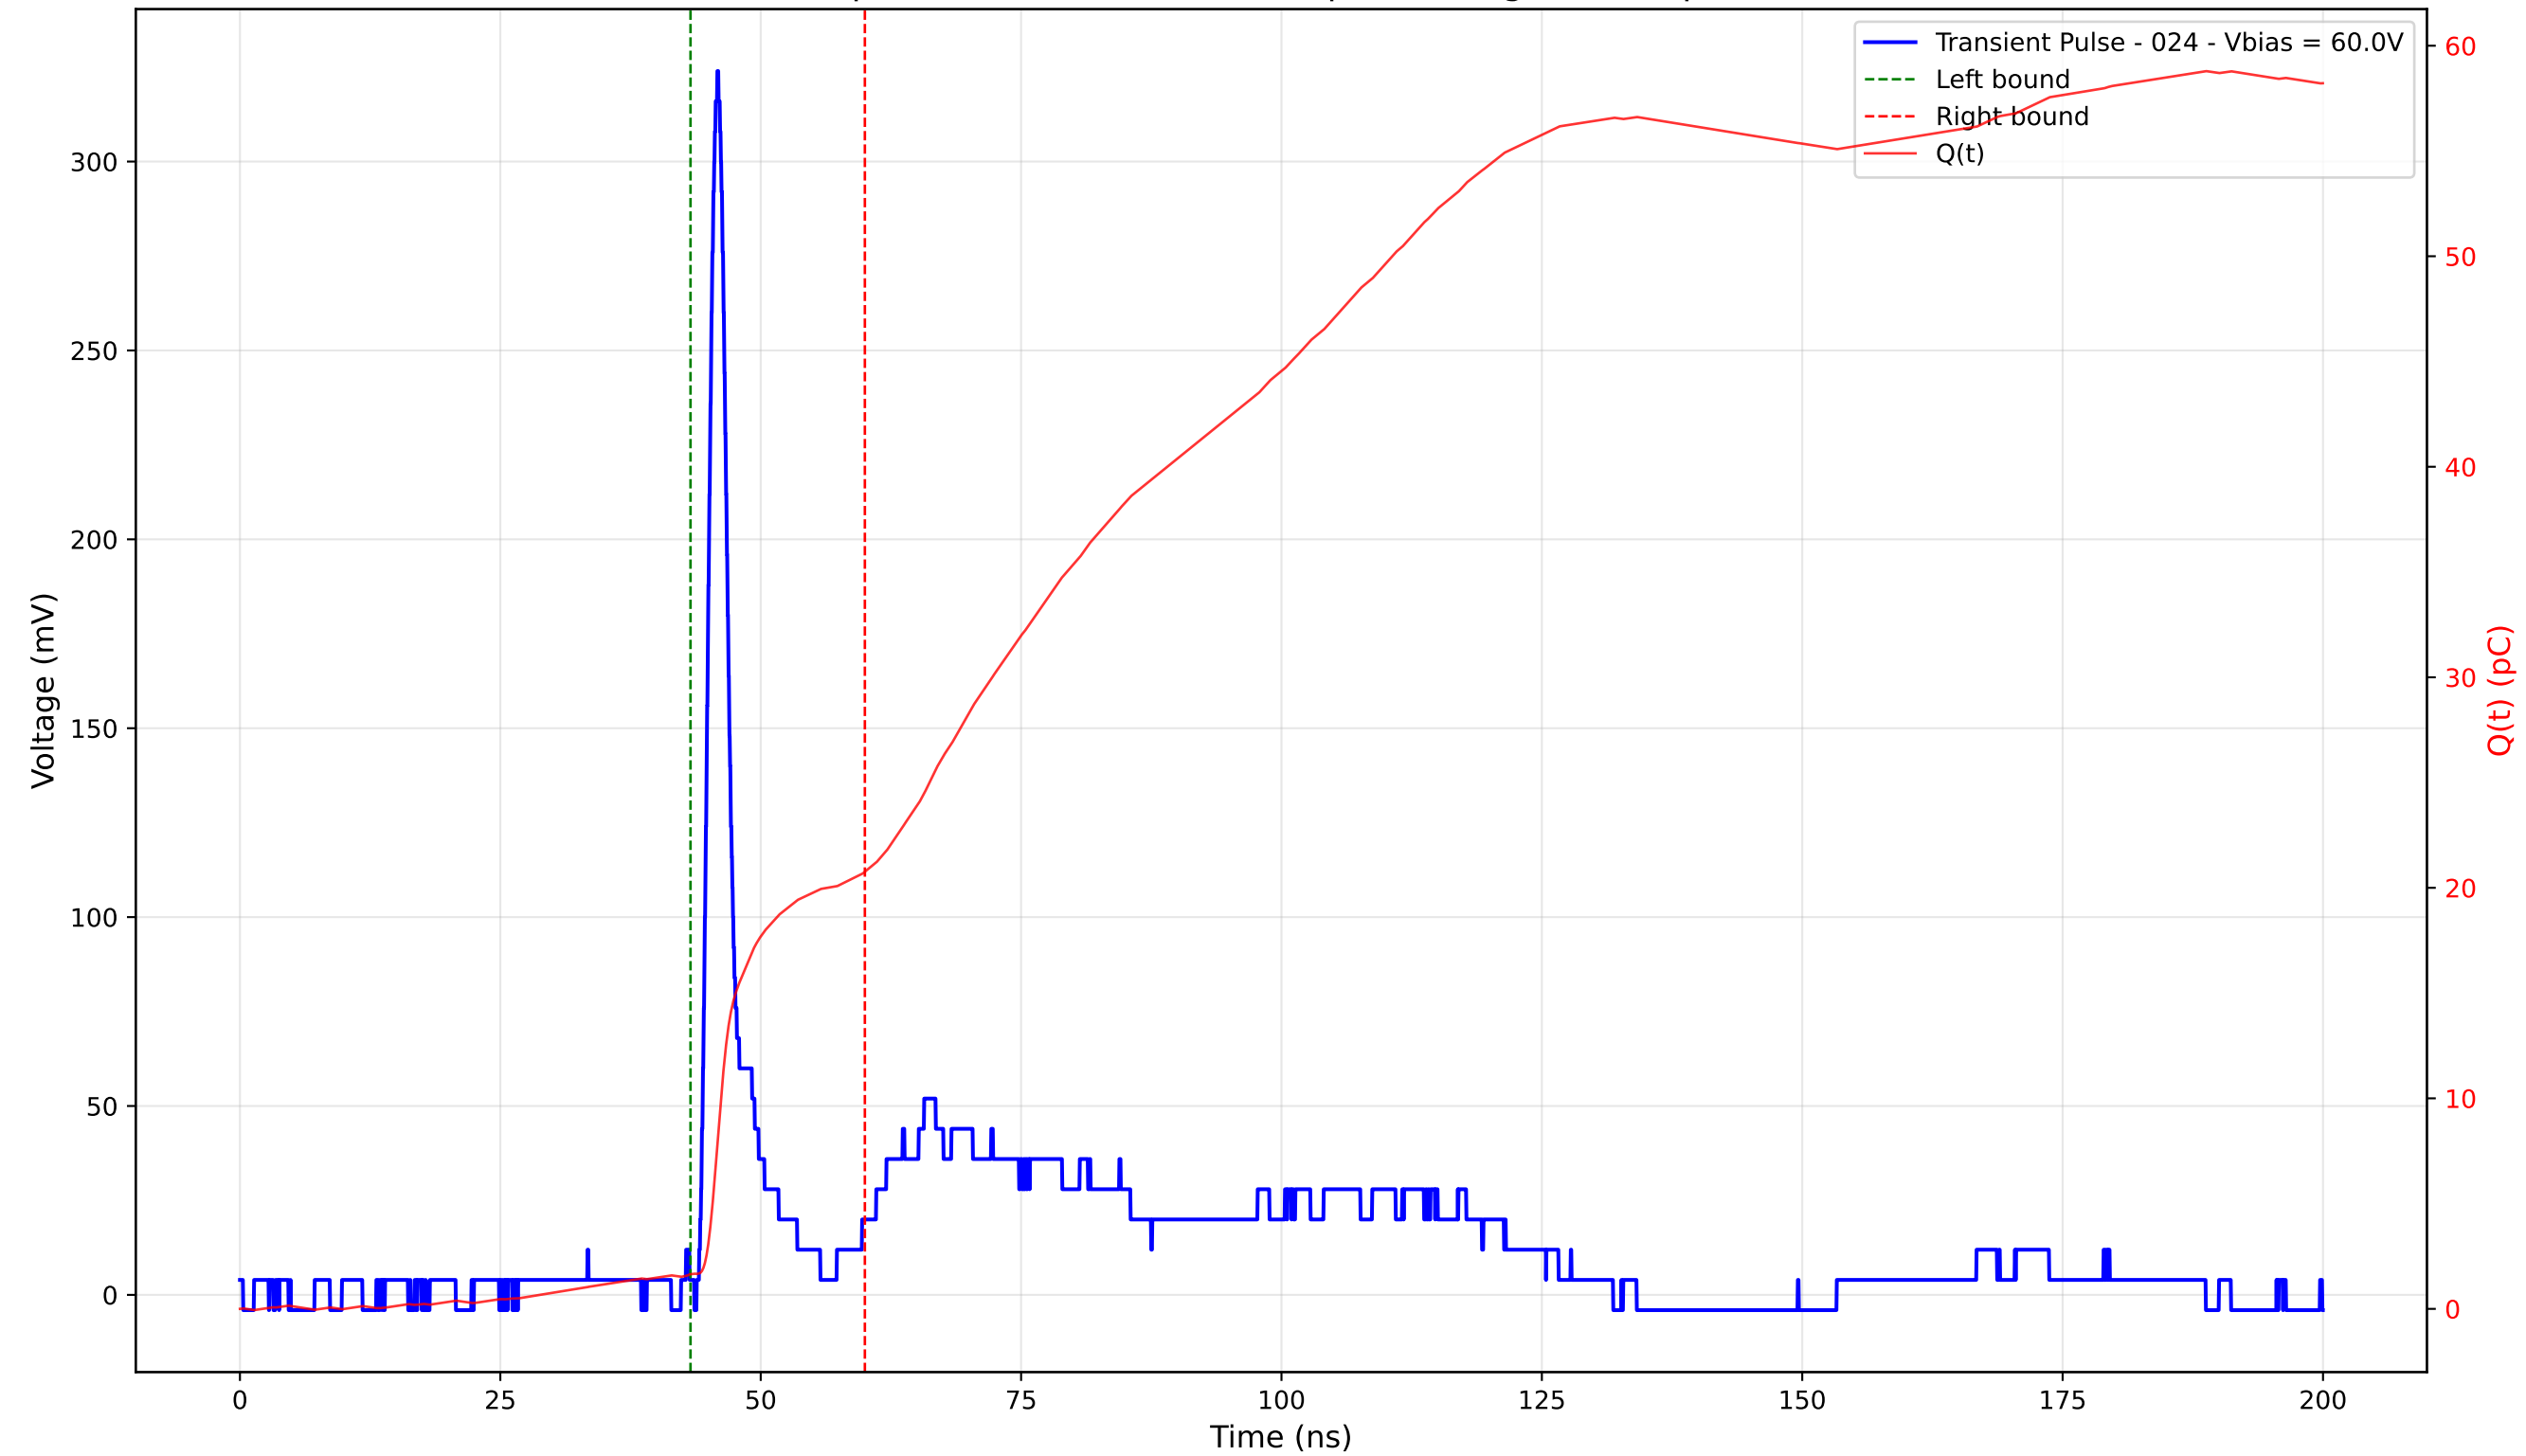


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 19.26 pC - Rise Time: 1.18 ns

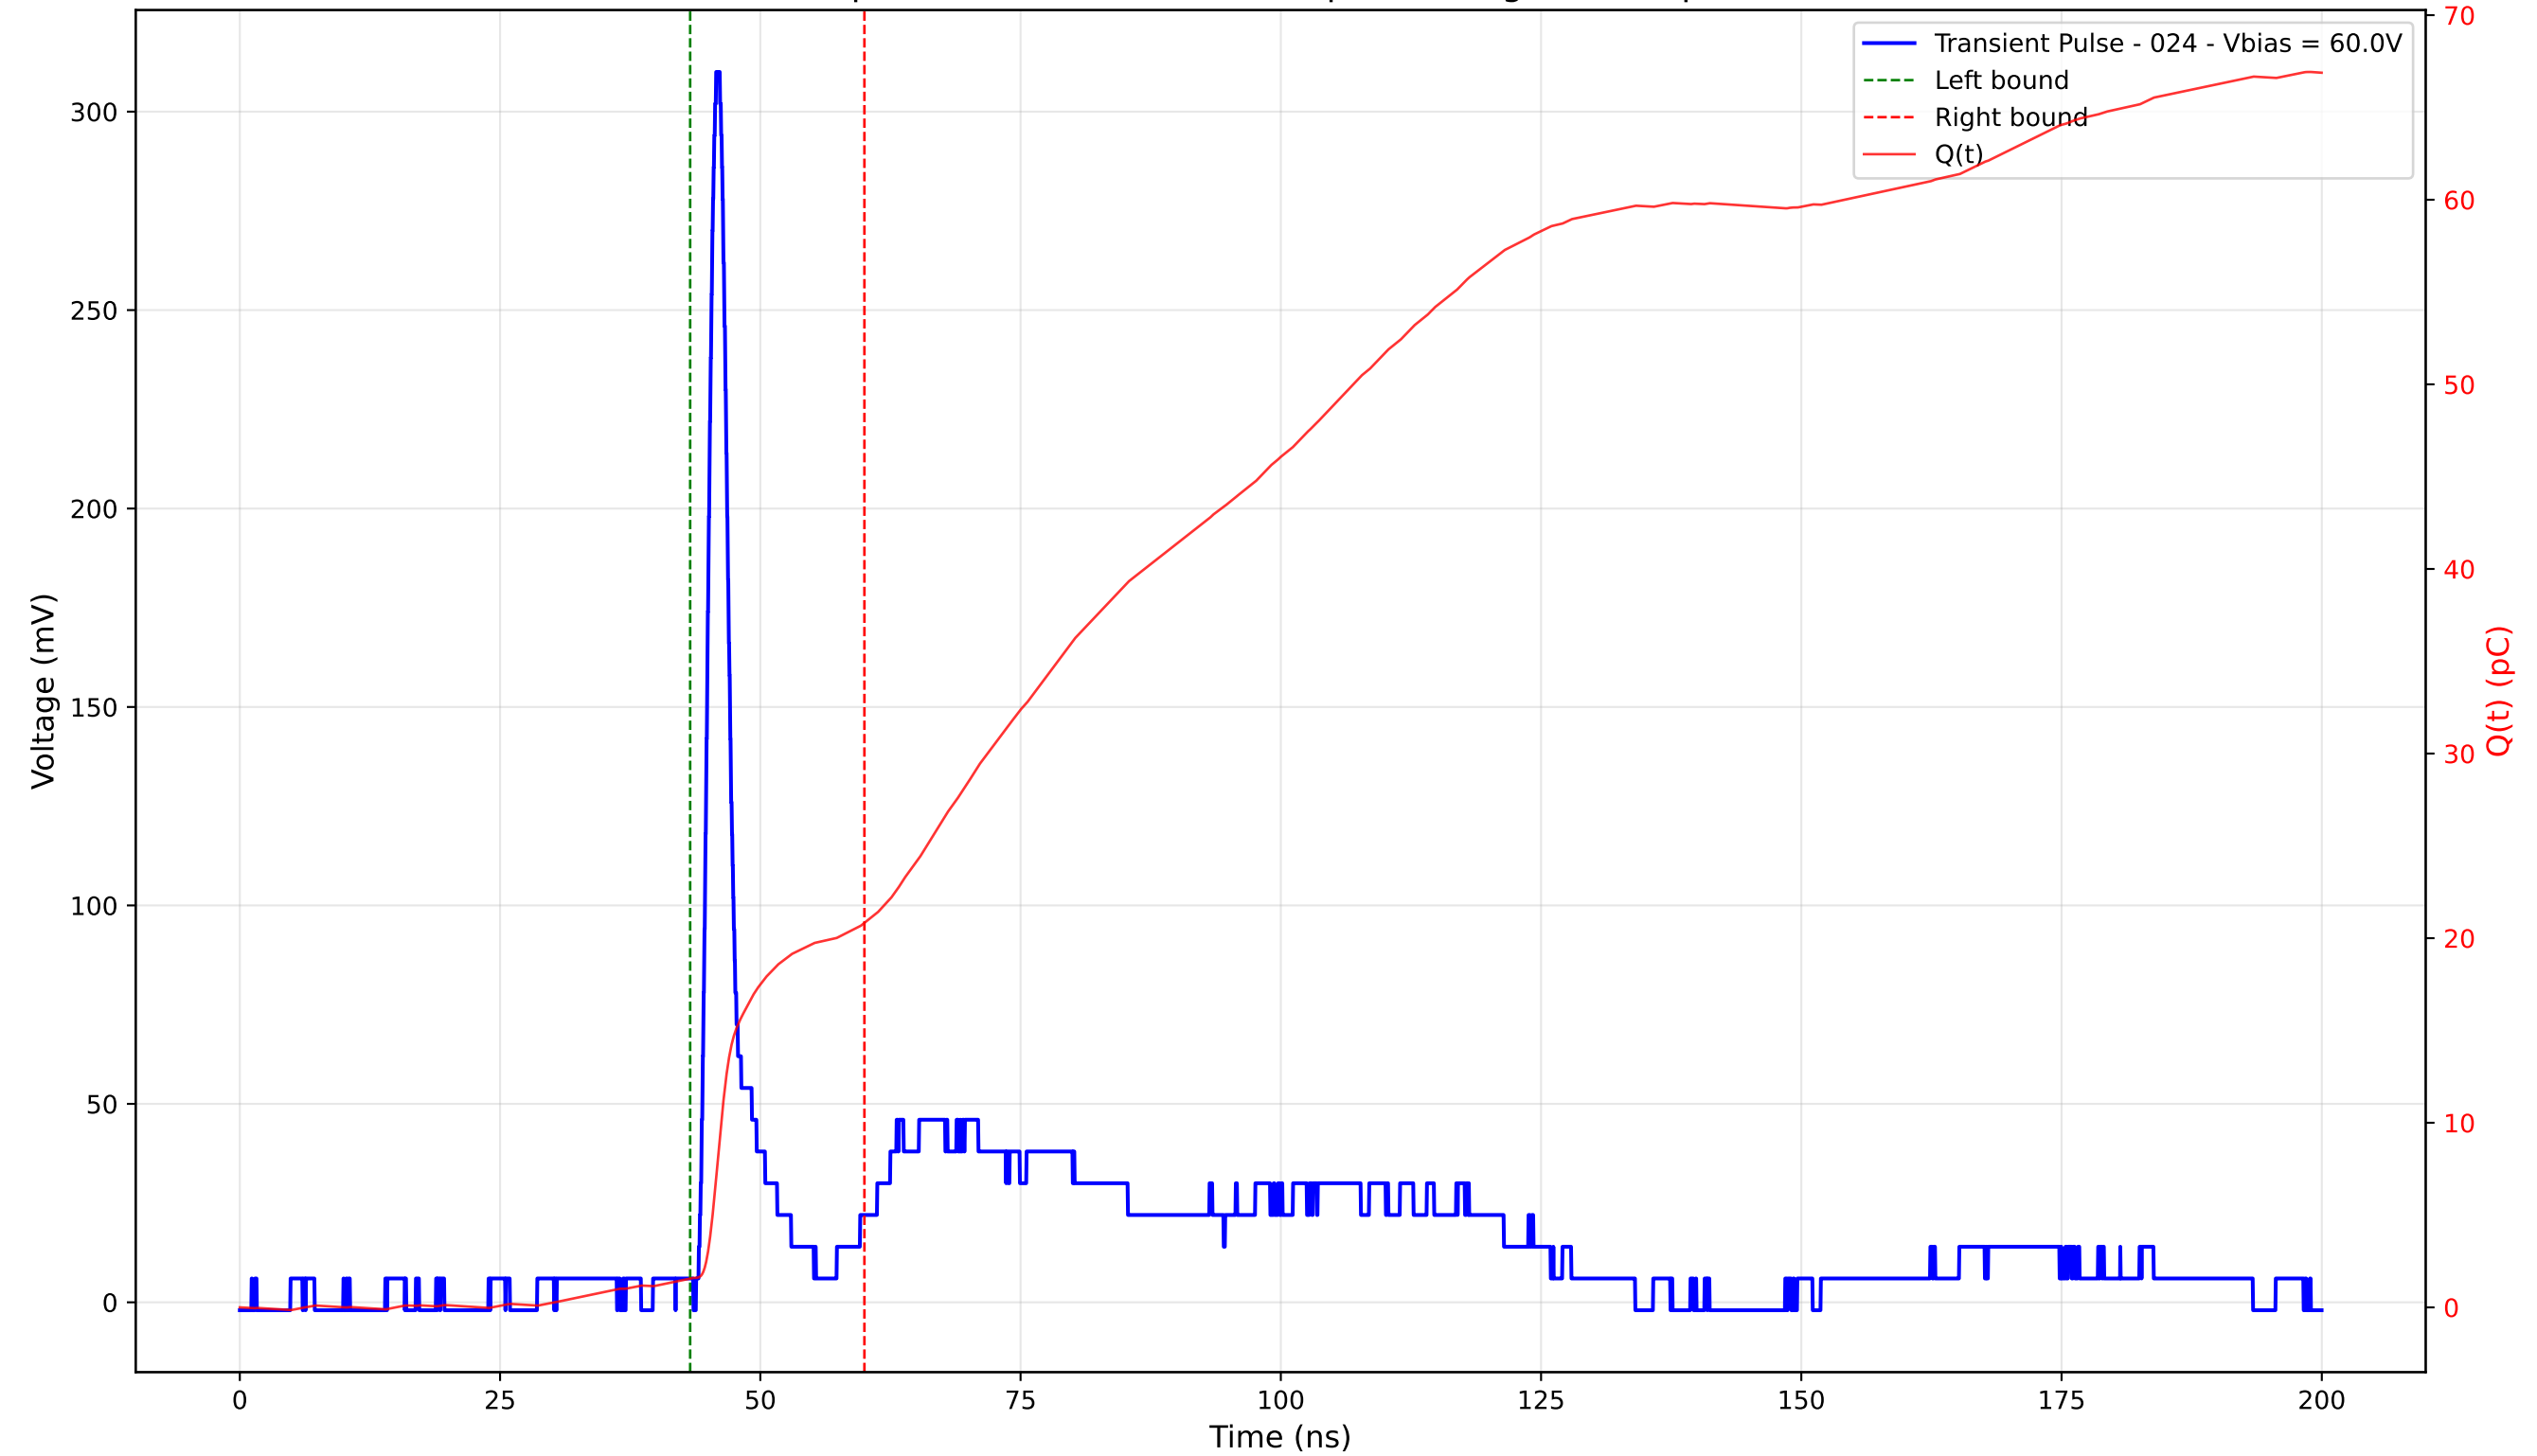


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 18.02 pC - Rise Time: 1.23 ns

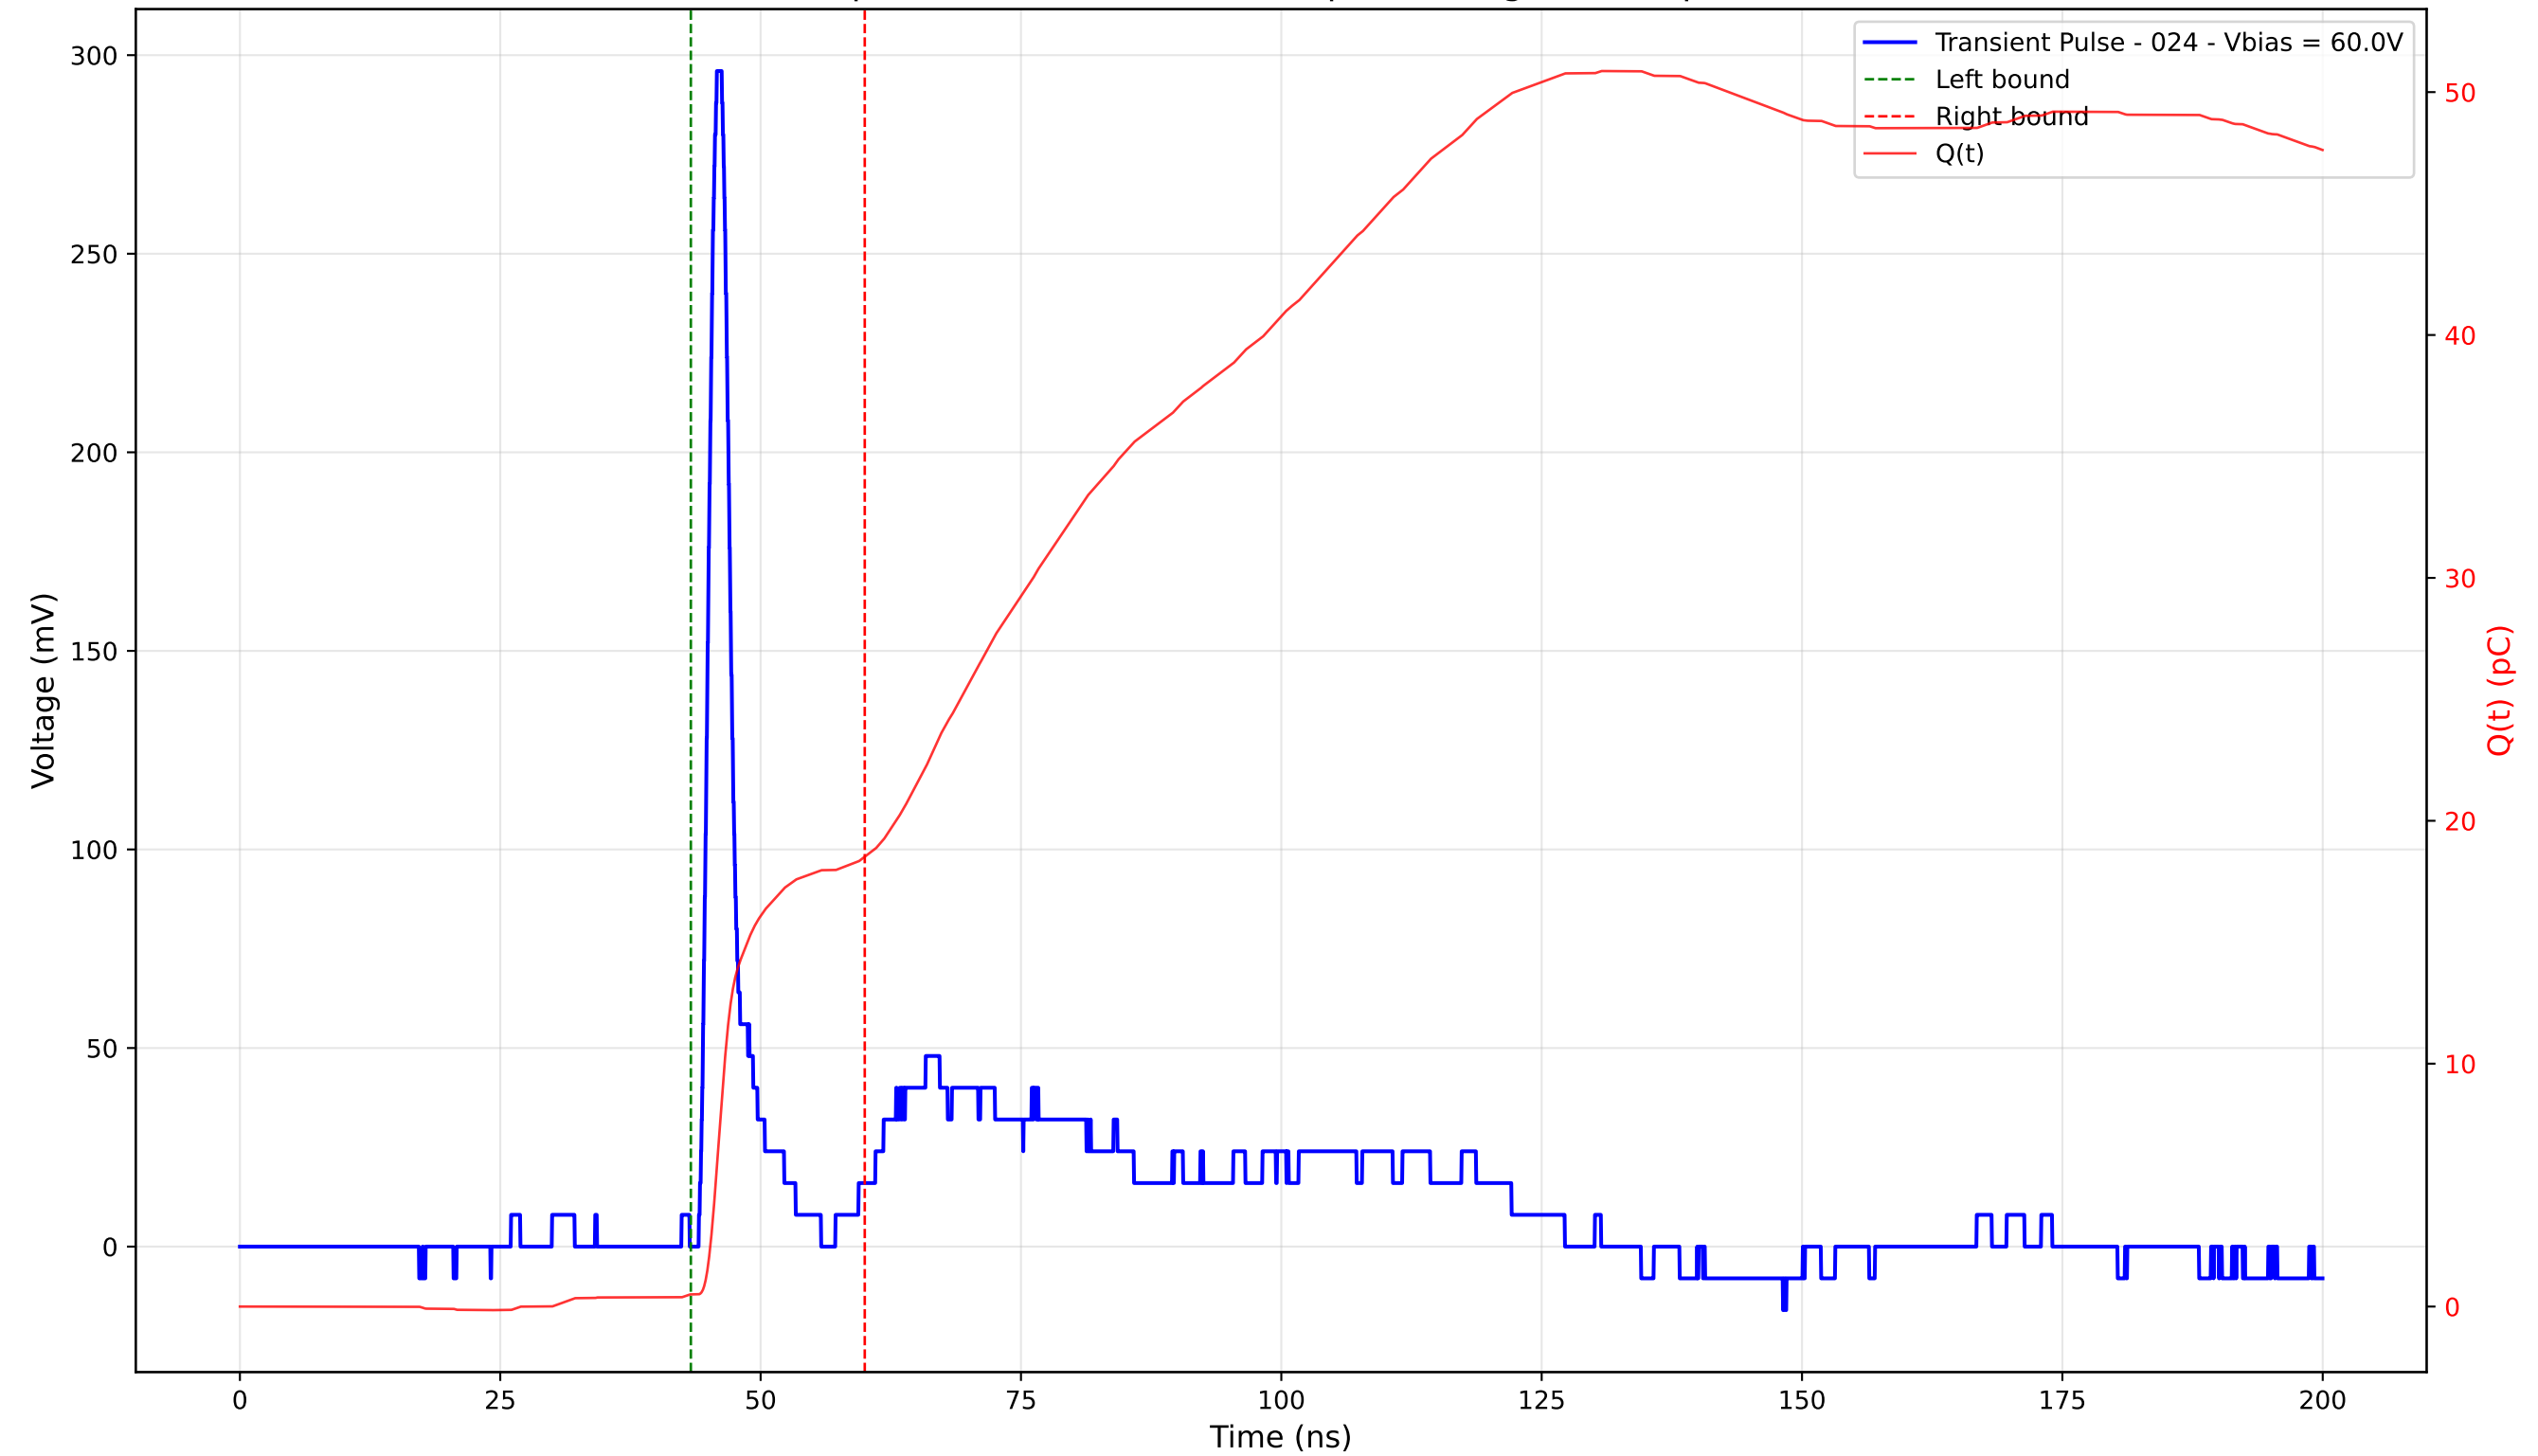


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 18.00 pC - Rise Time: 1.27 ns

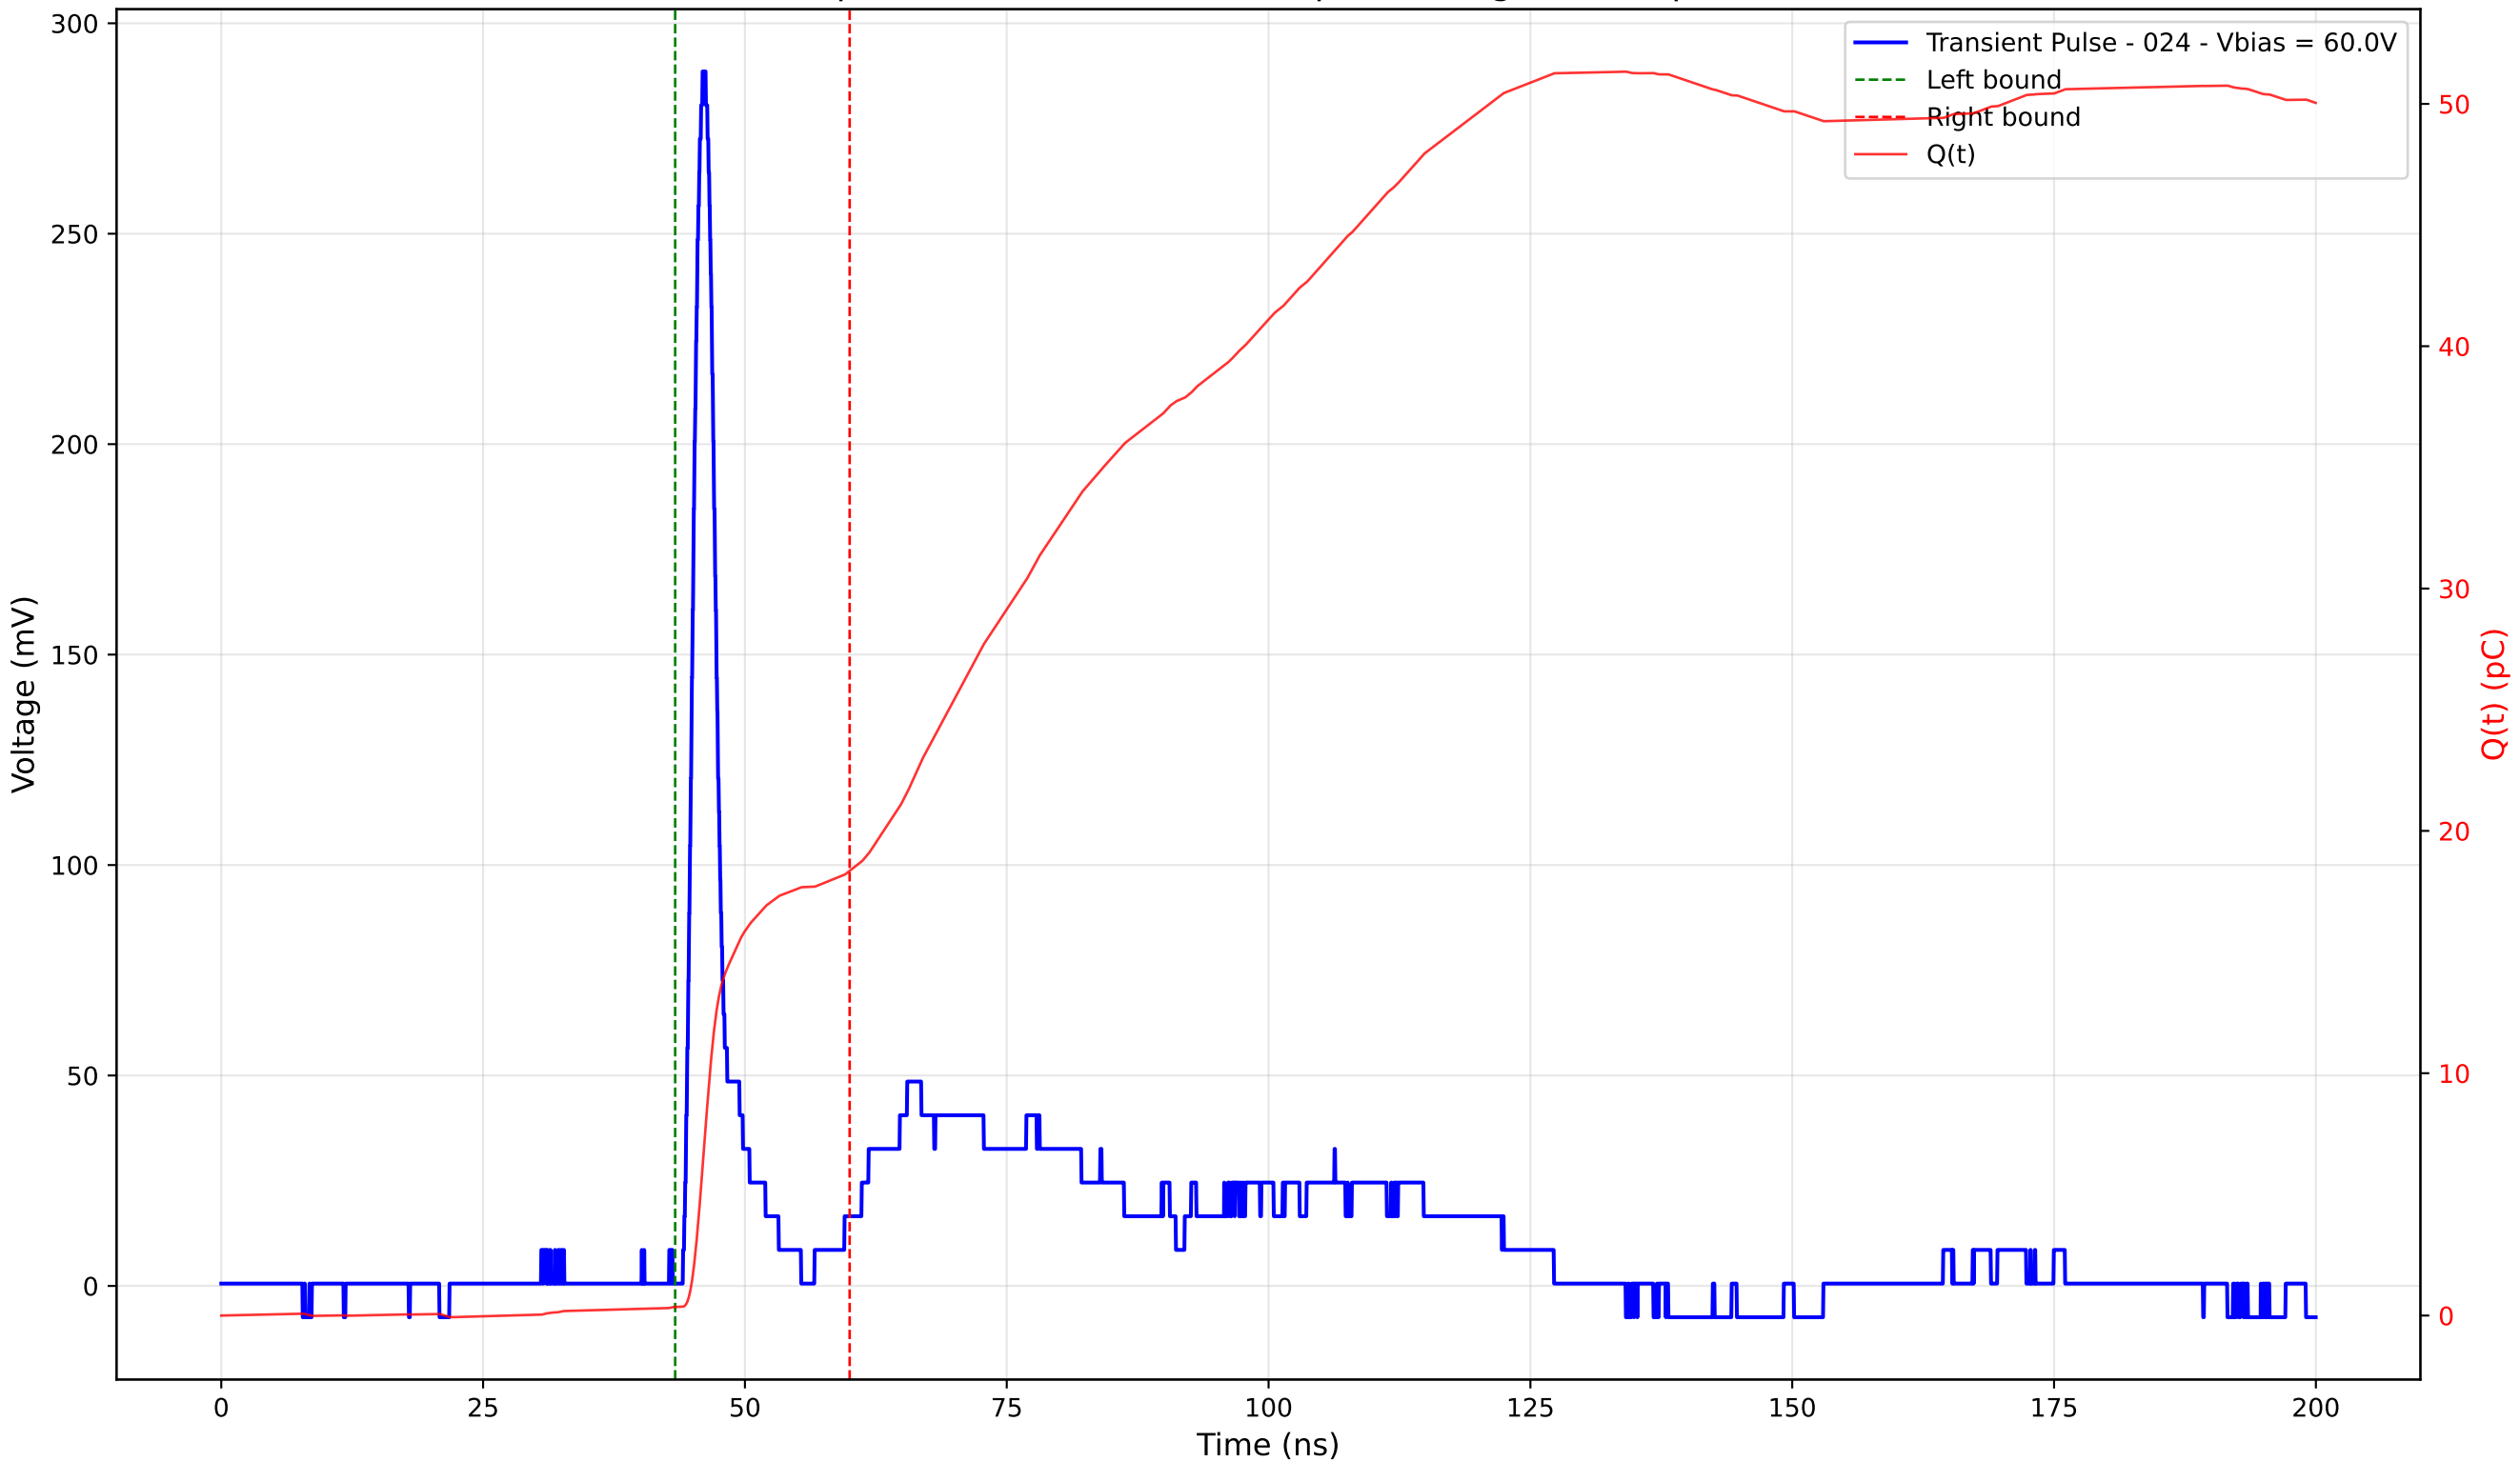


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 17.89 pC - Rise Time: 1.38 ns

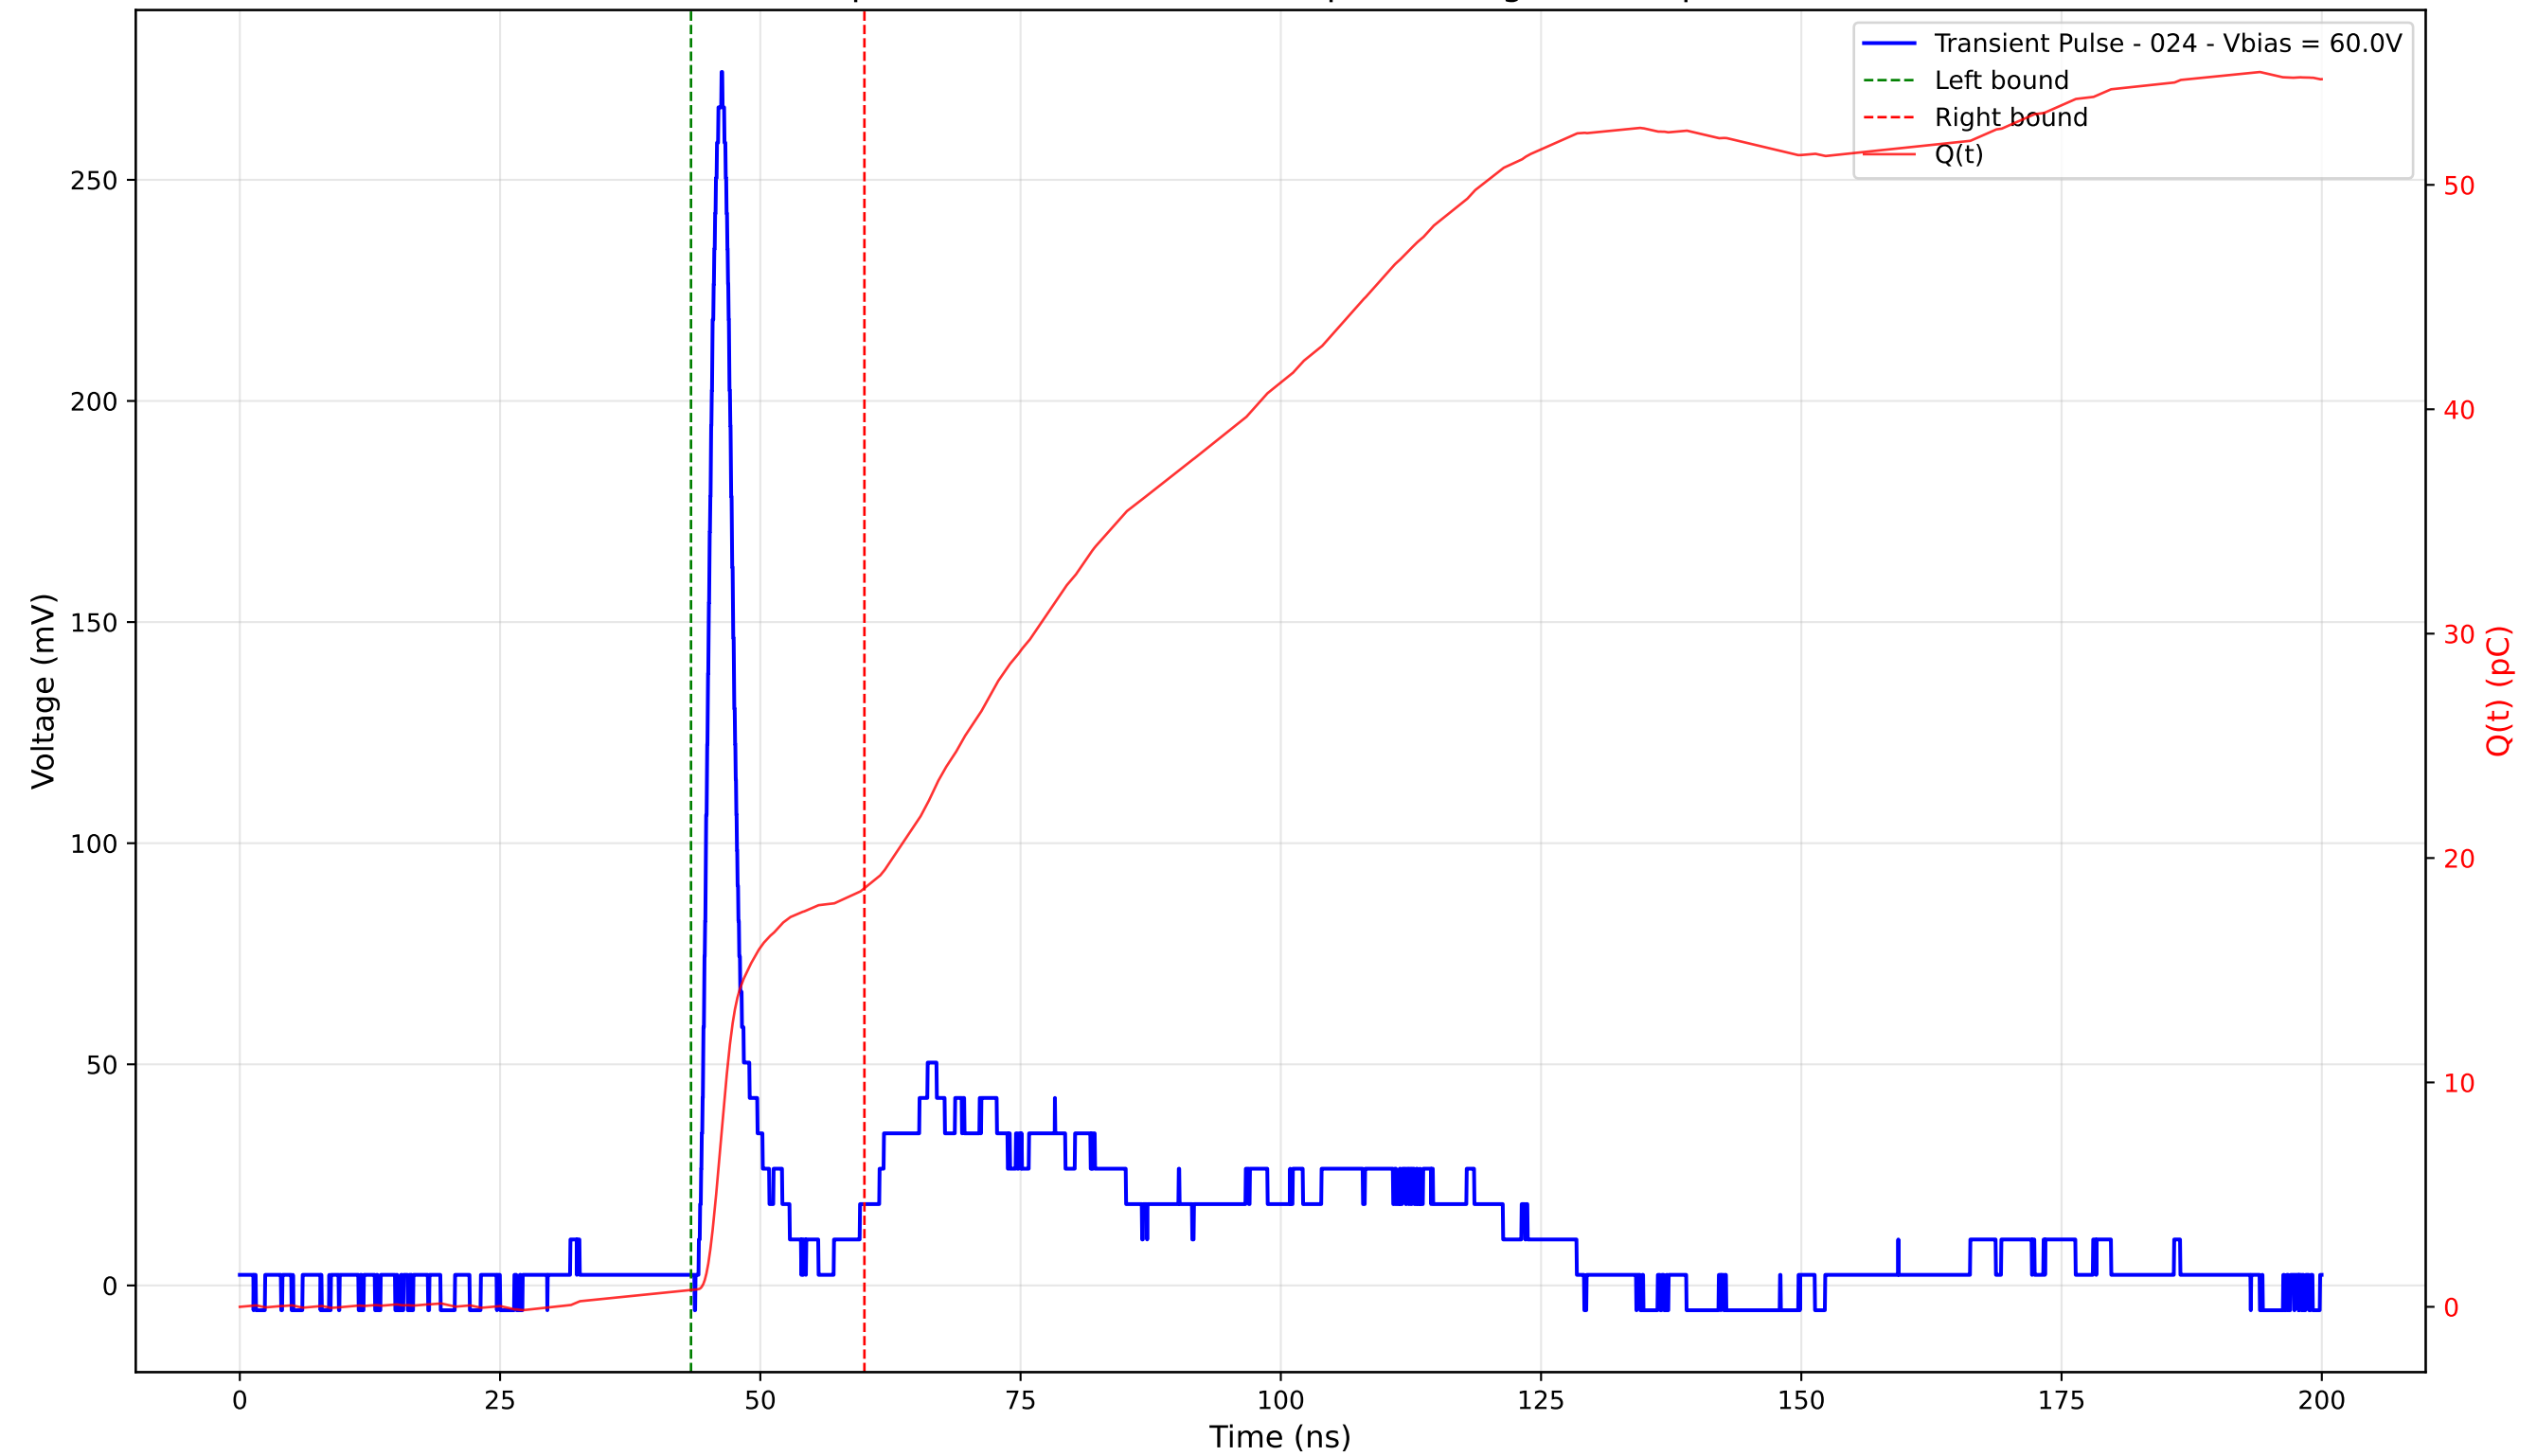


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 17.51 pC - Rise Time: 1.44 ns

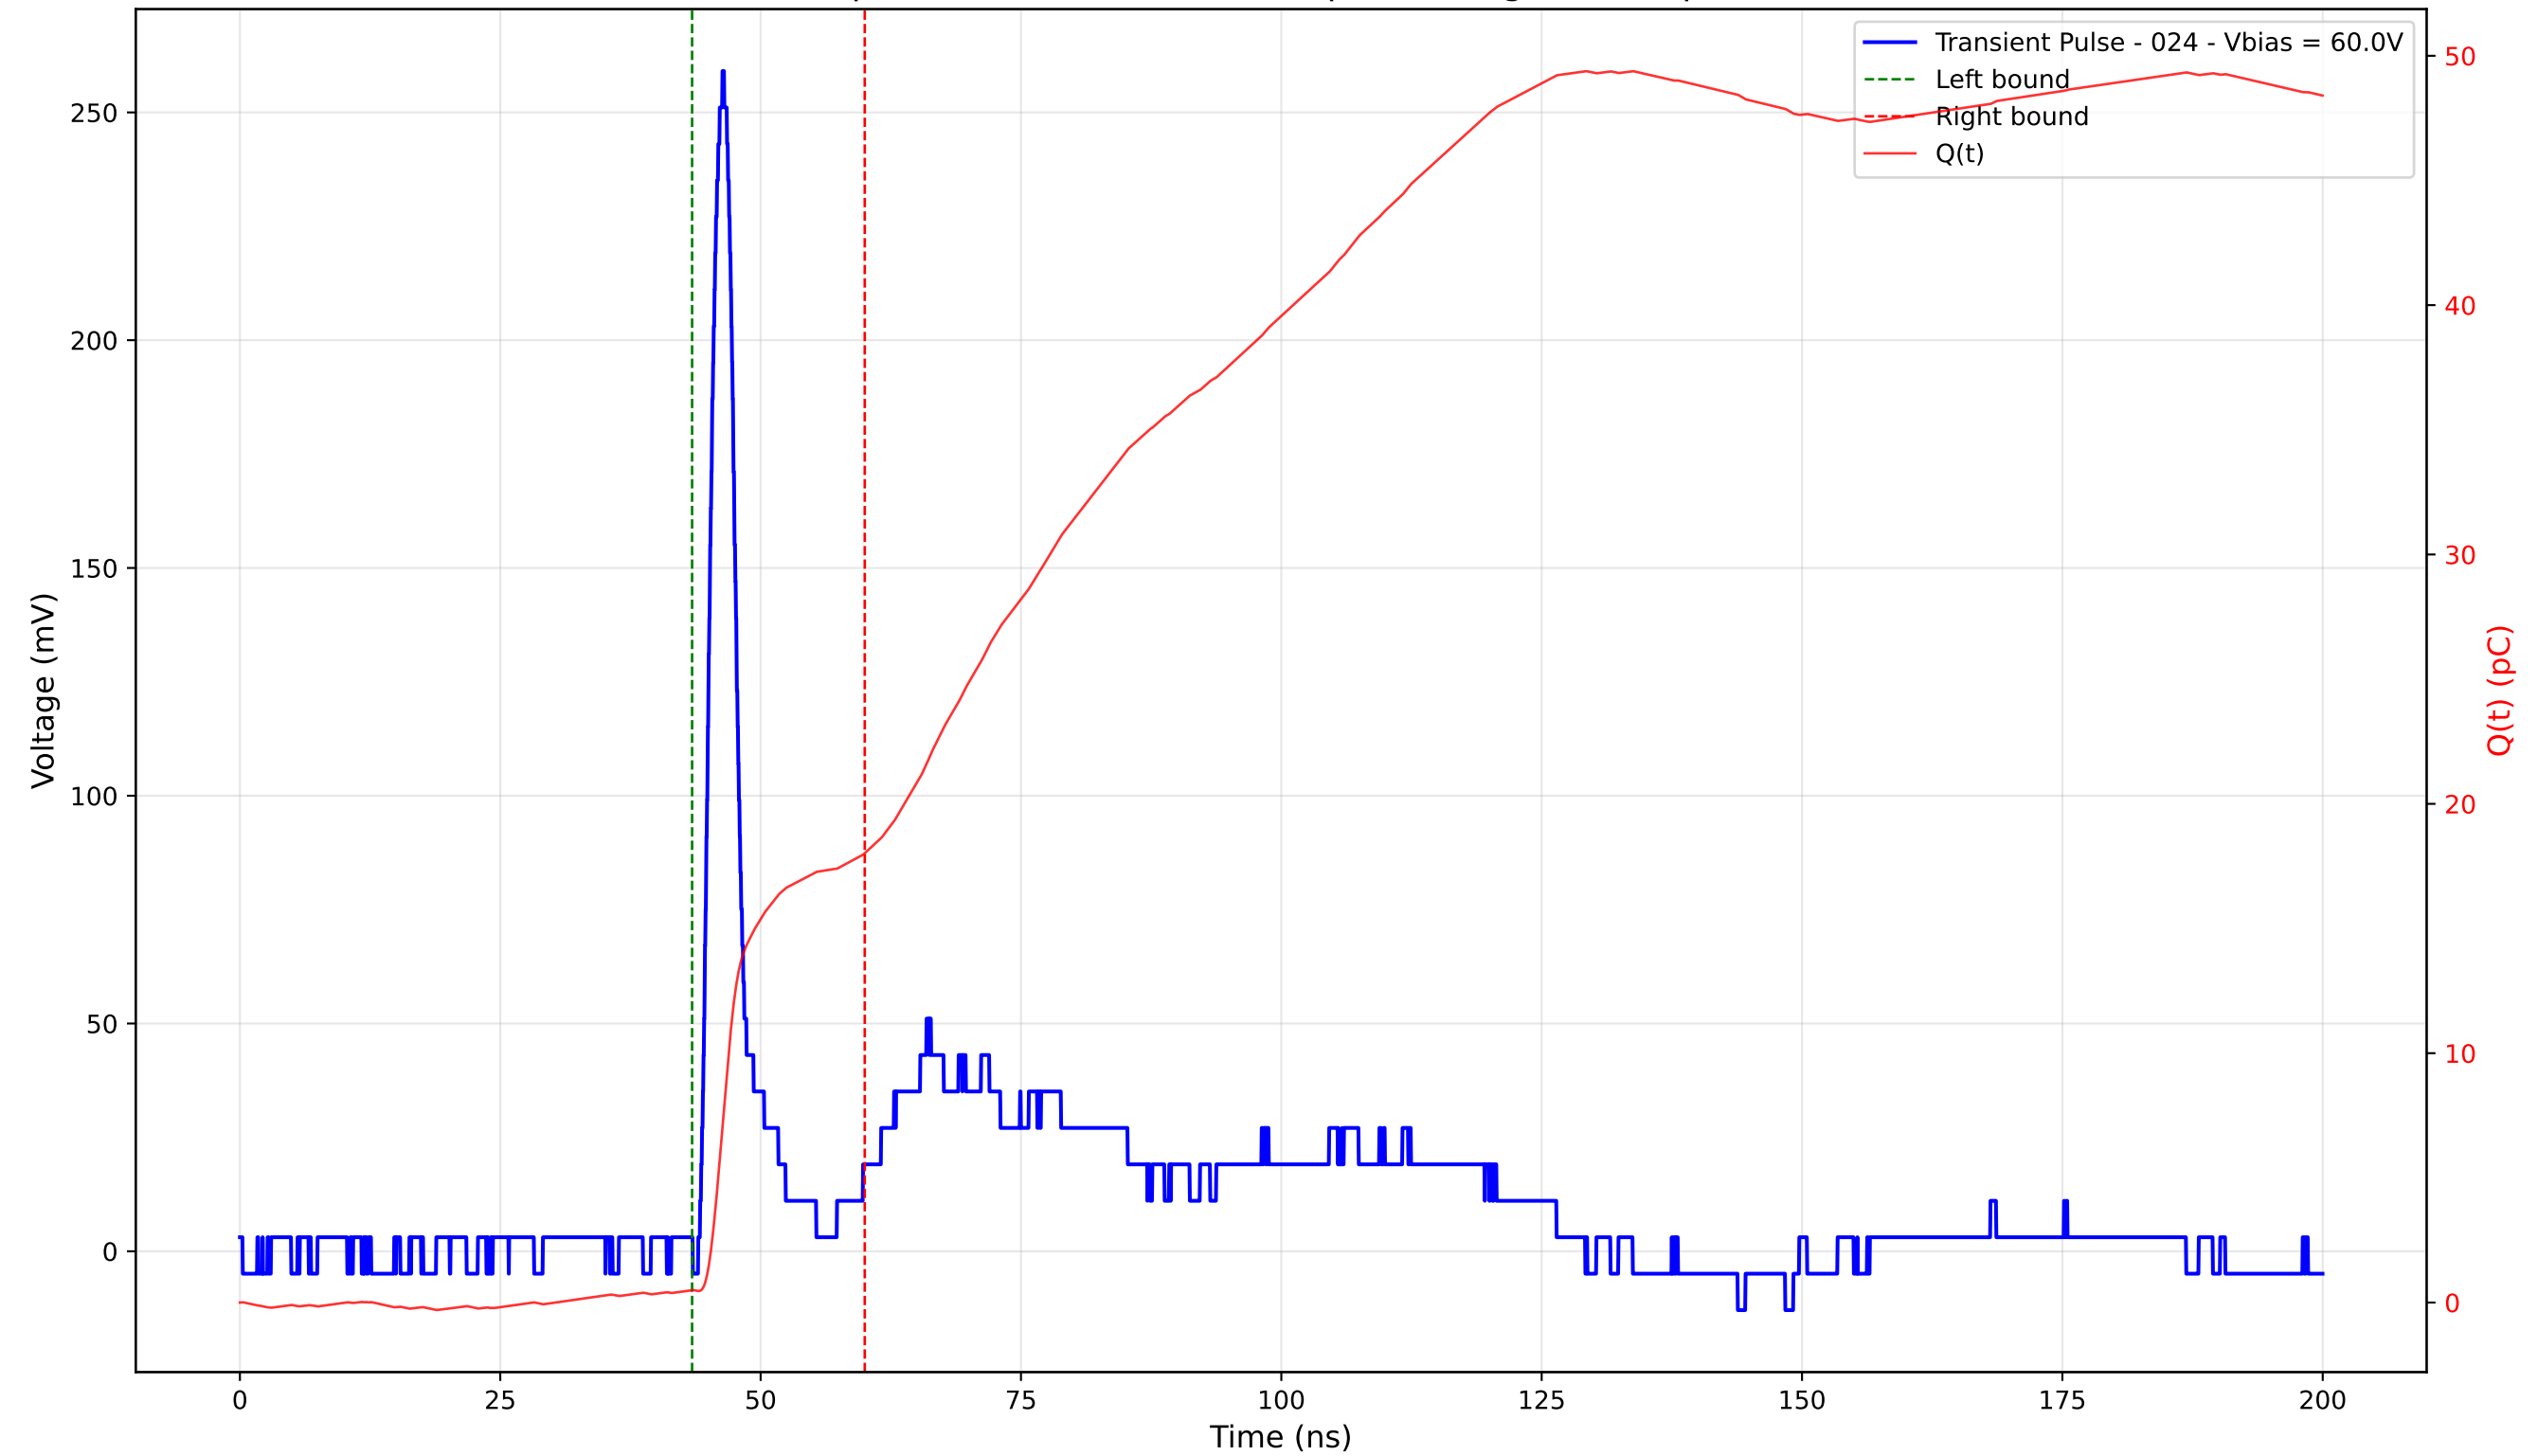


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 17.83 pC - Rise Time: 1.57 ns

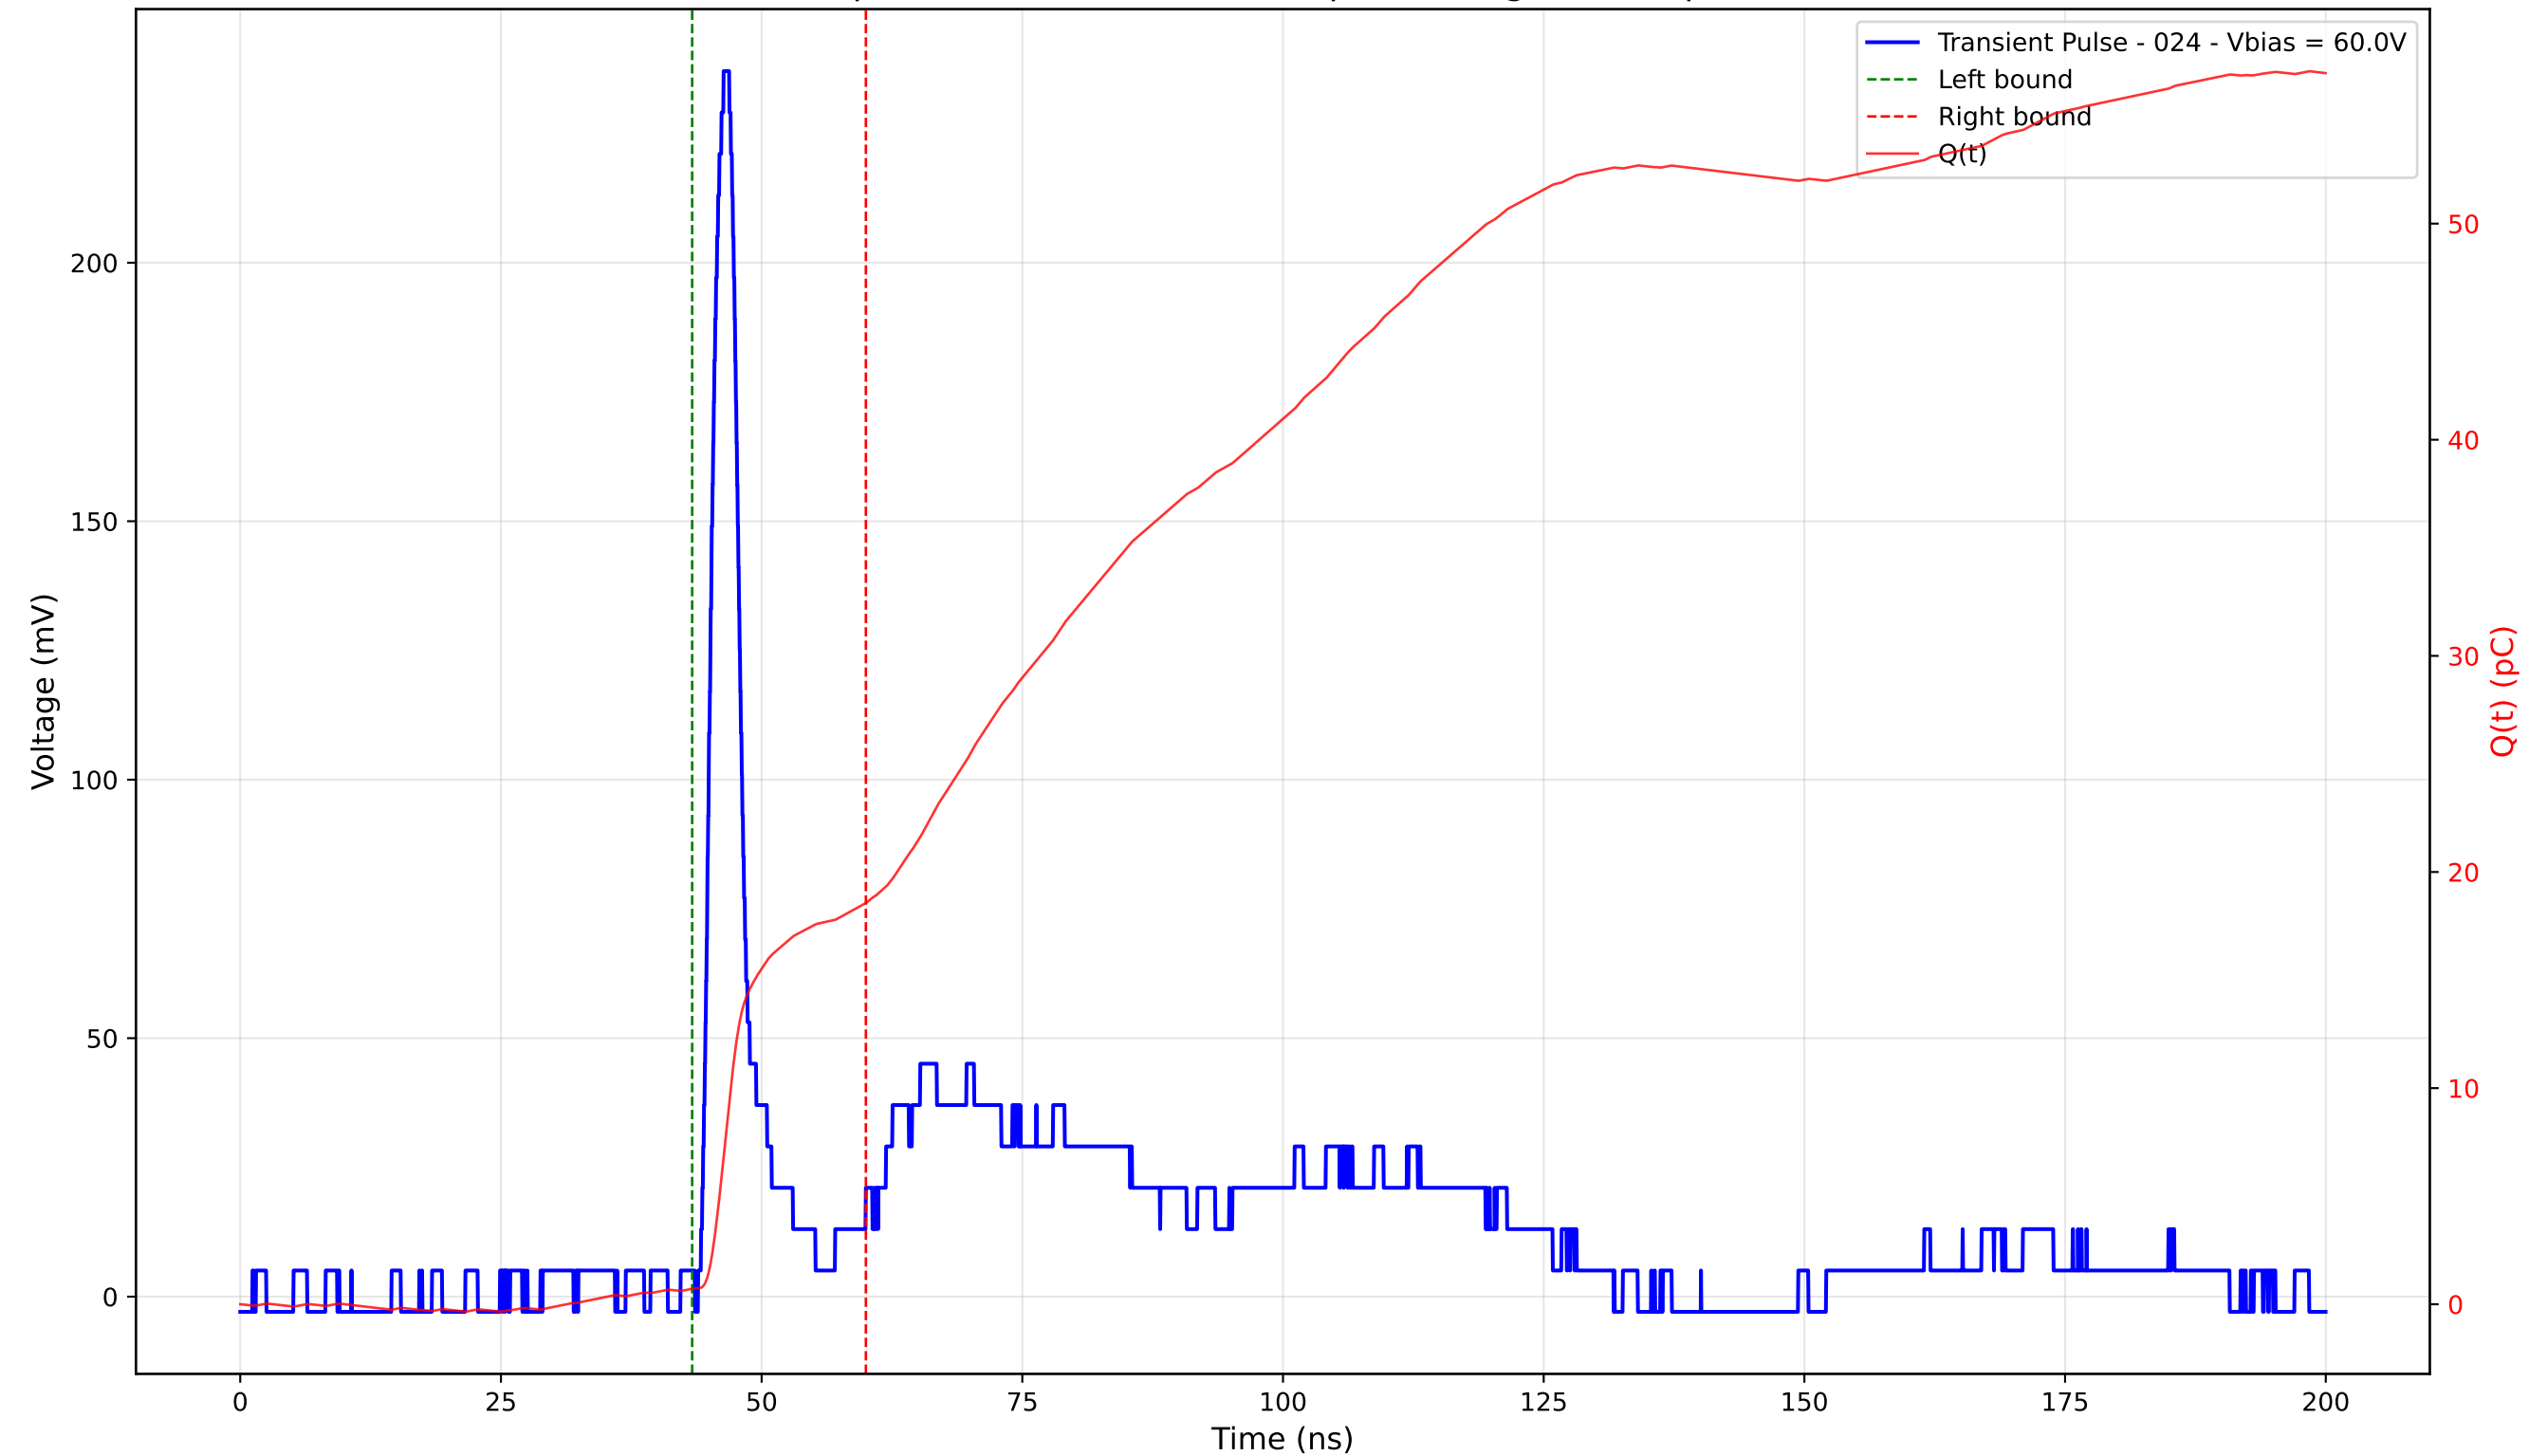


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 17.00 pC - Rise Time: 1.83 ns

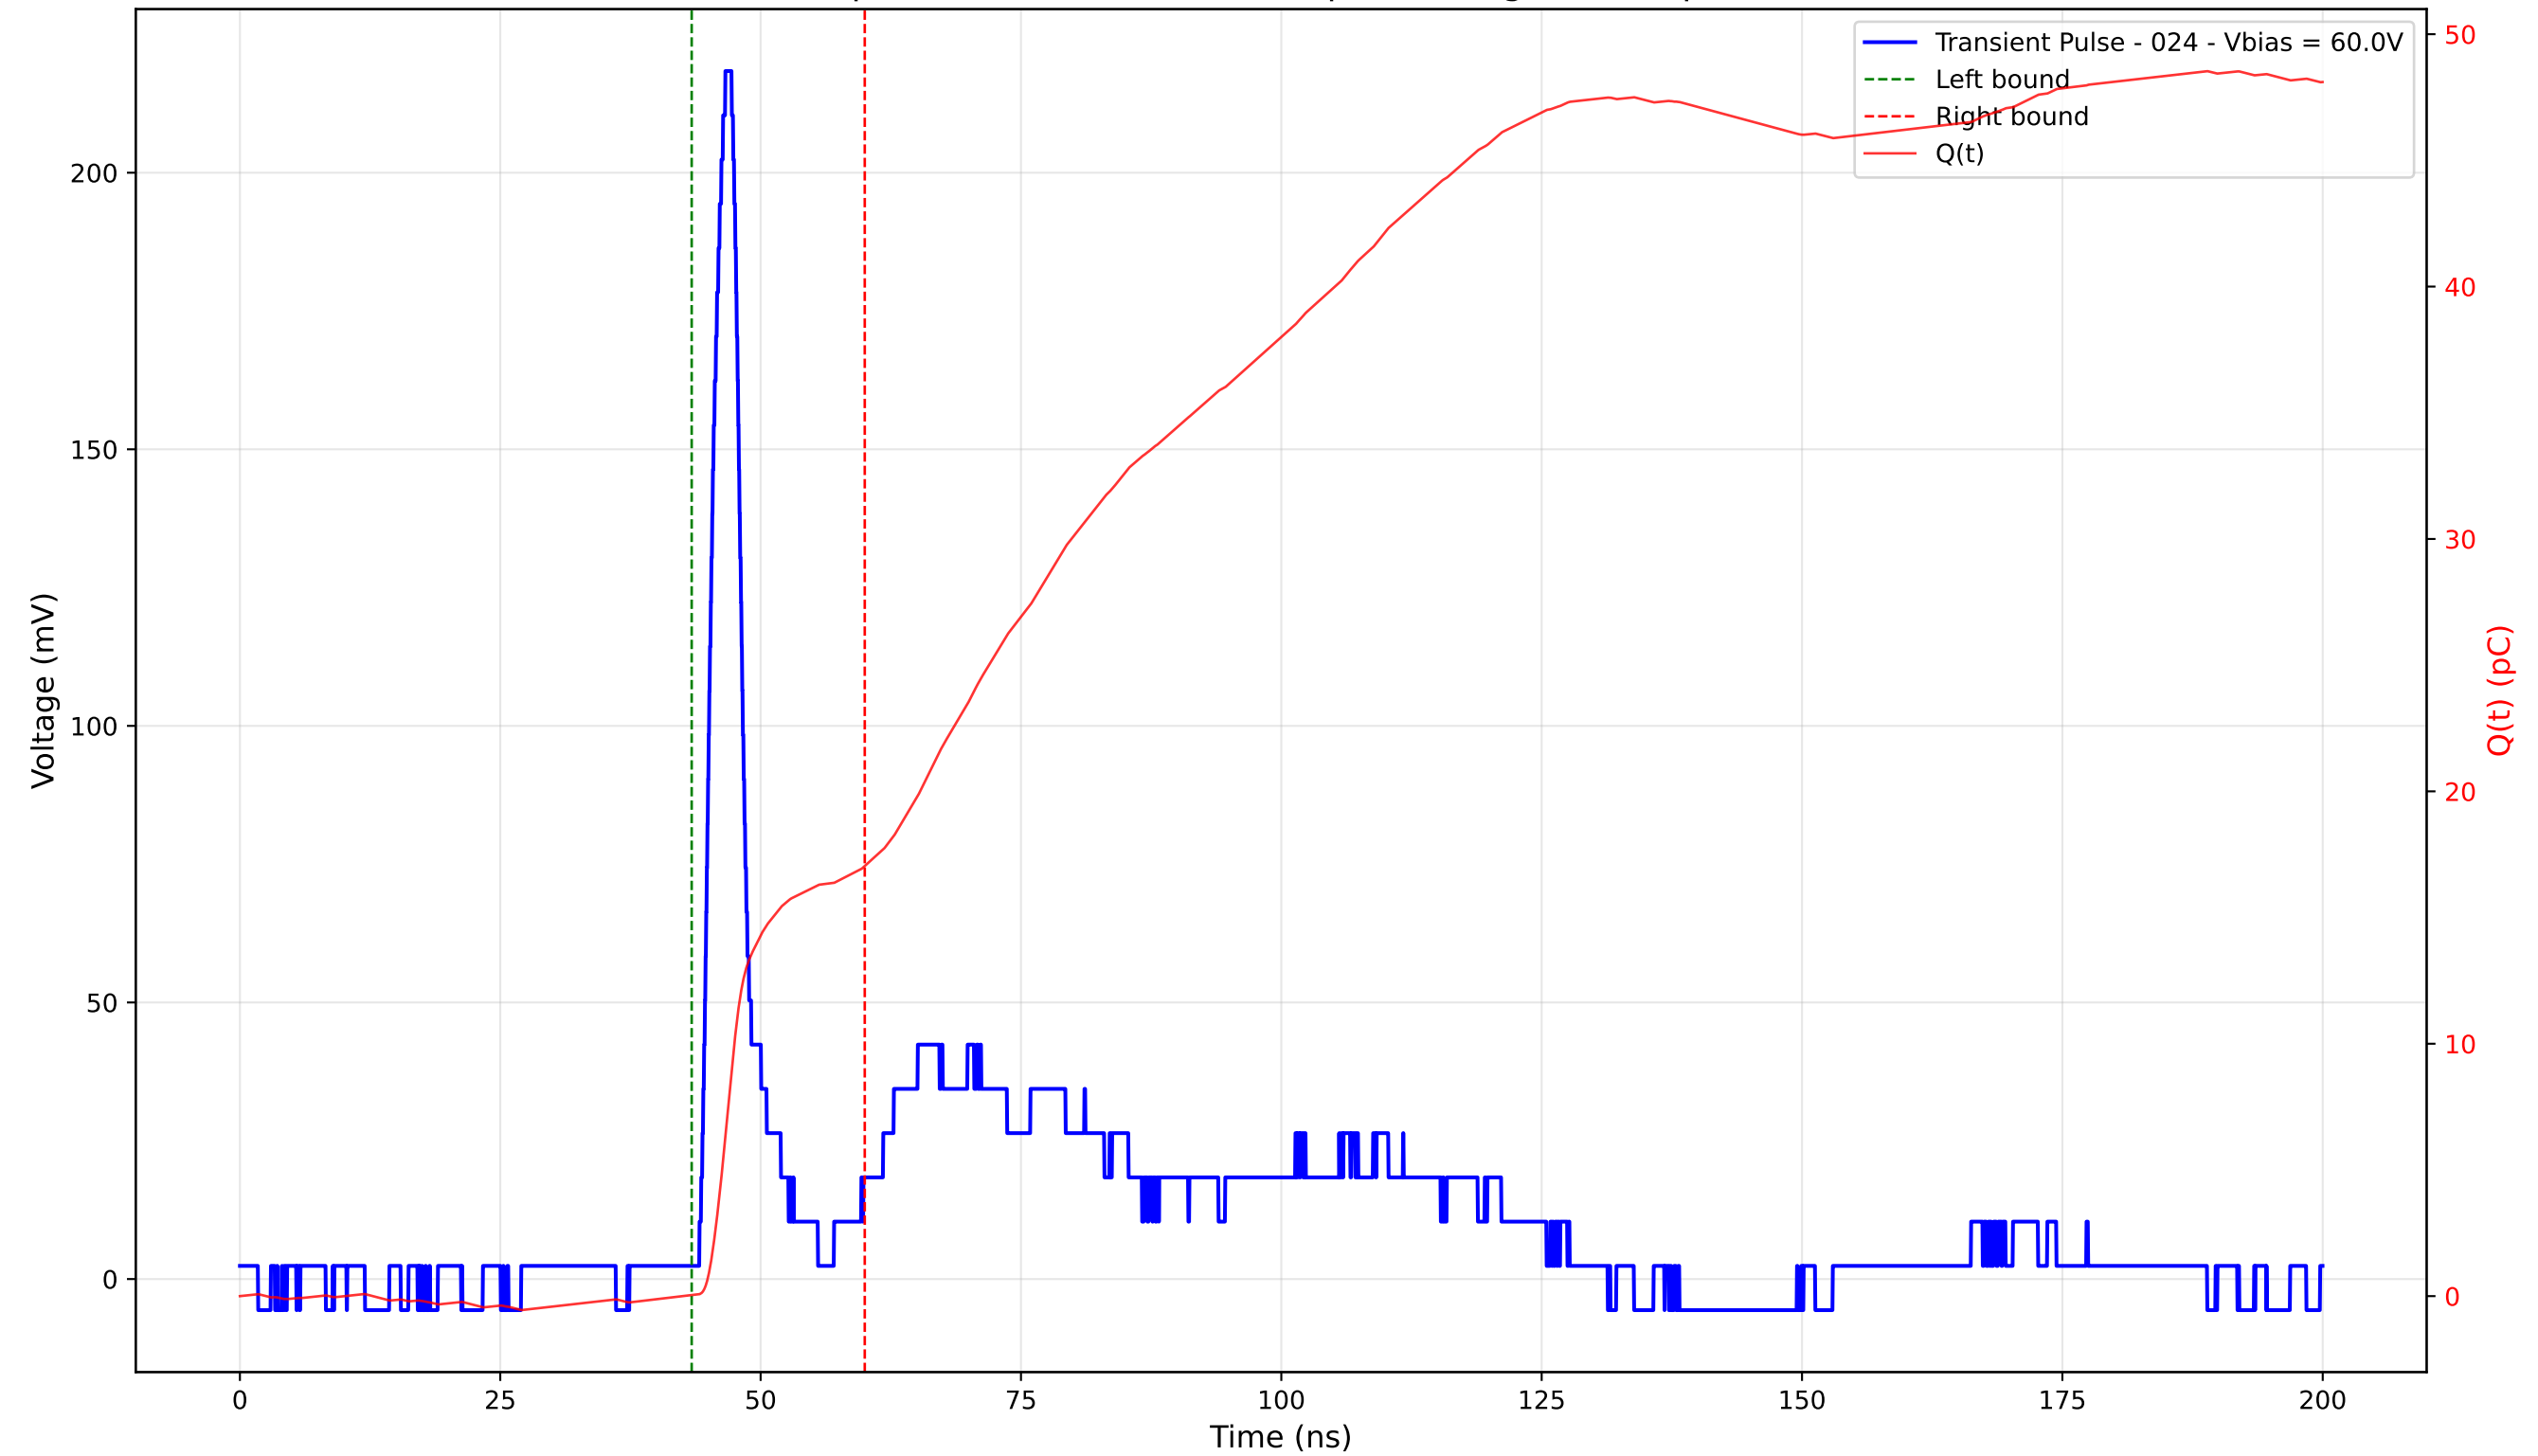


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 16.41 pC - Rise Time: 2.04 ns

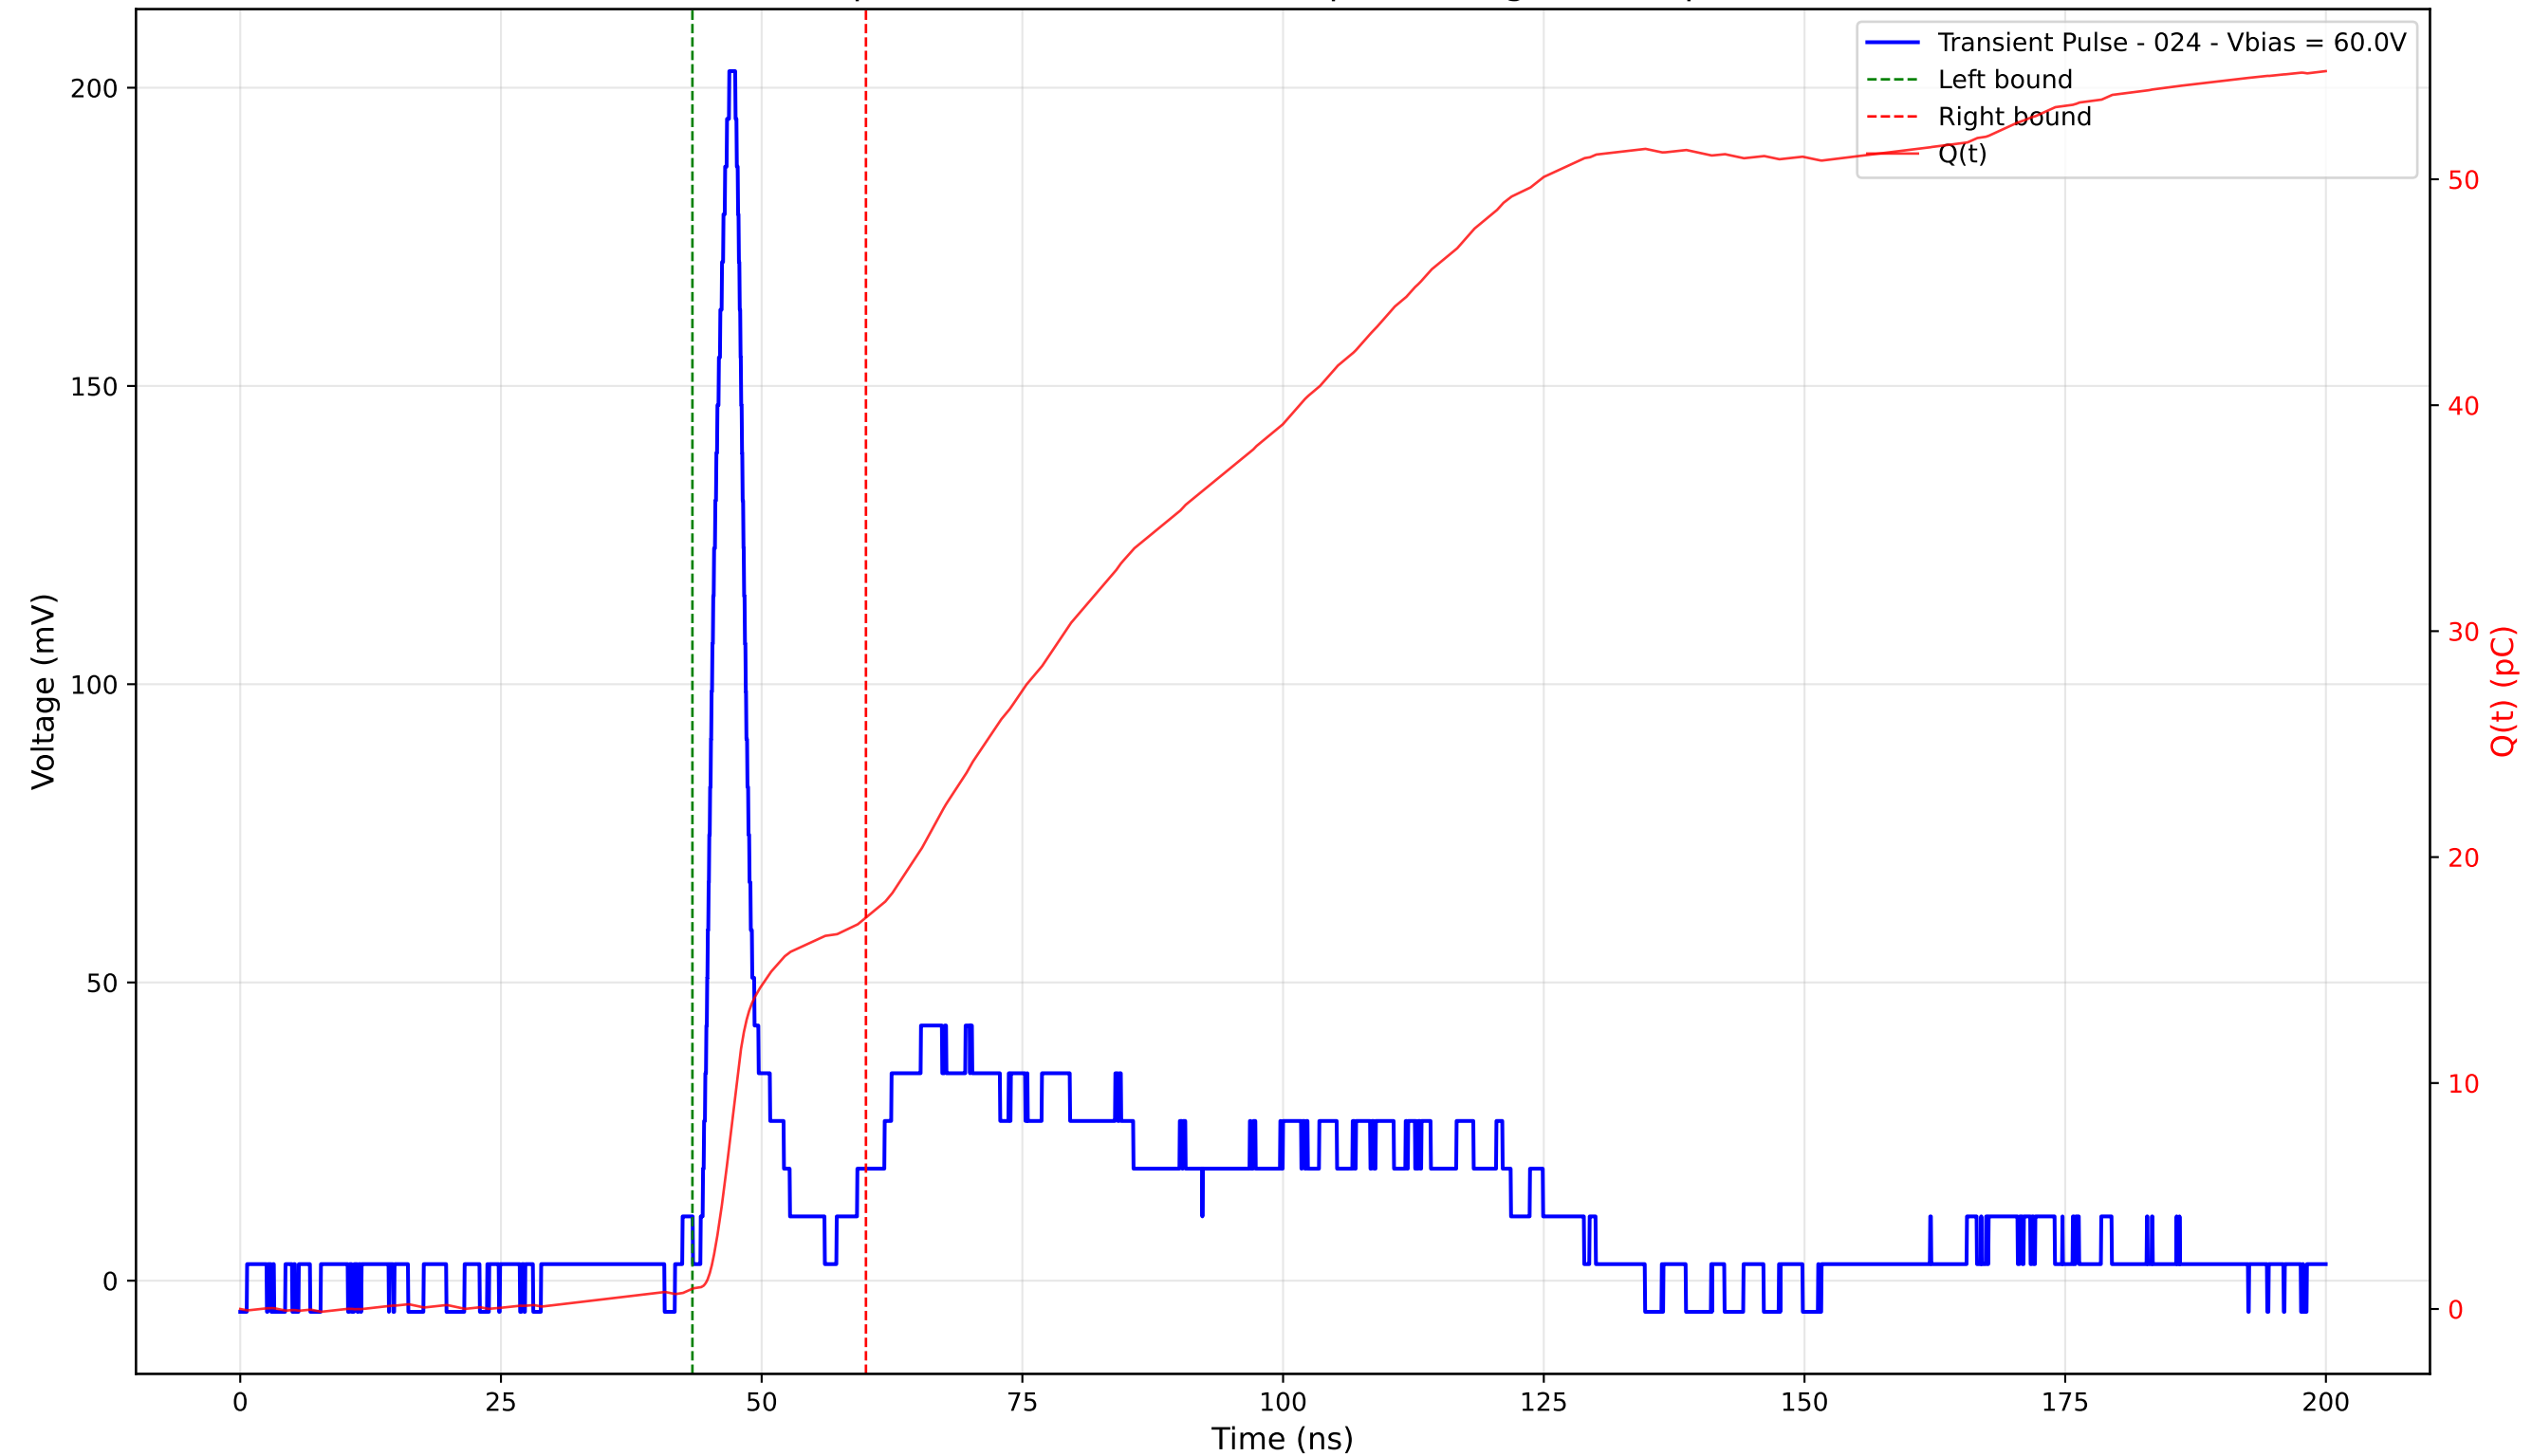


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 15.84 pC - Rise Time: 2.40 ns

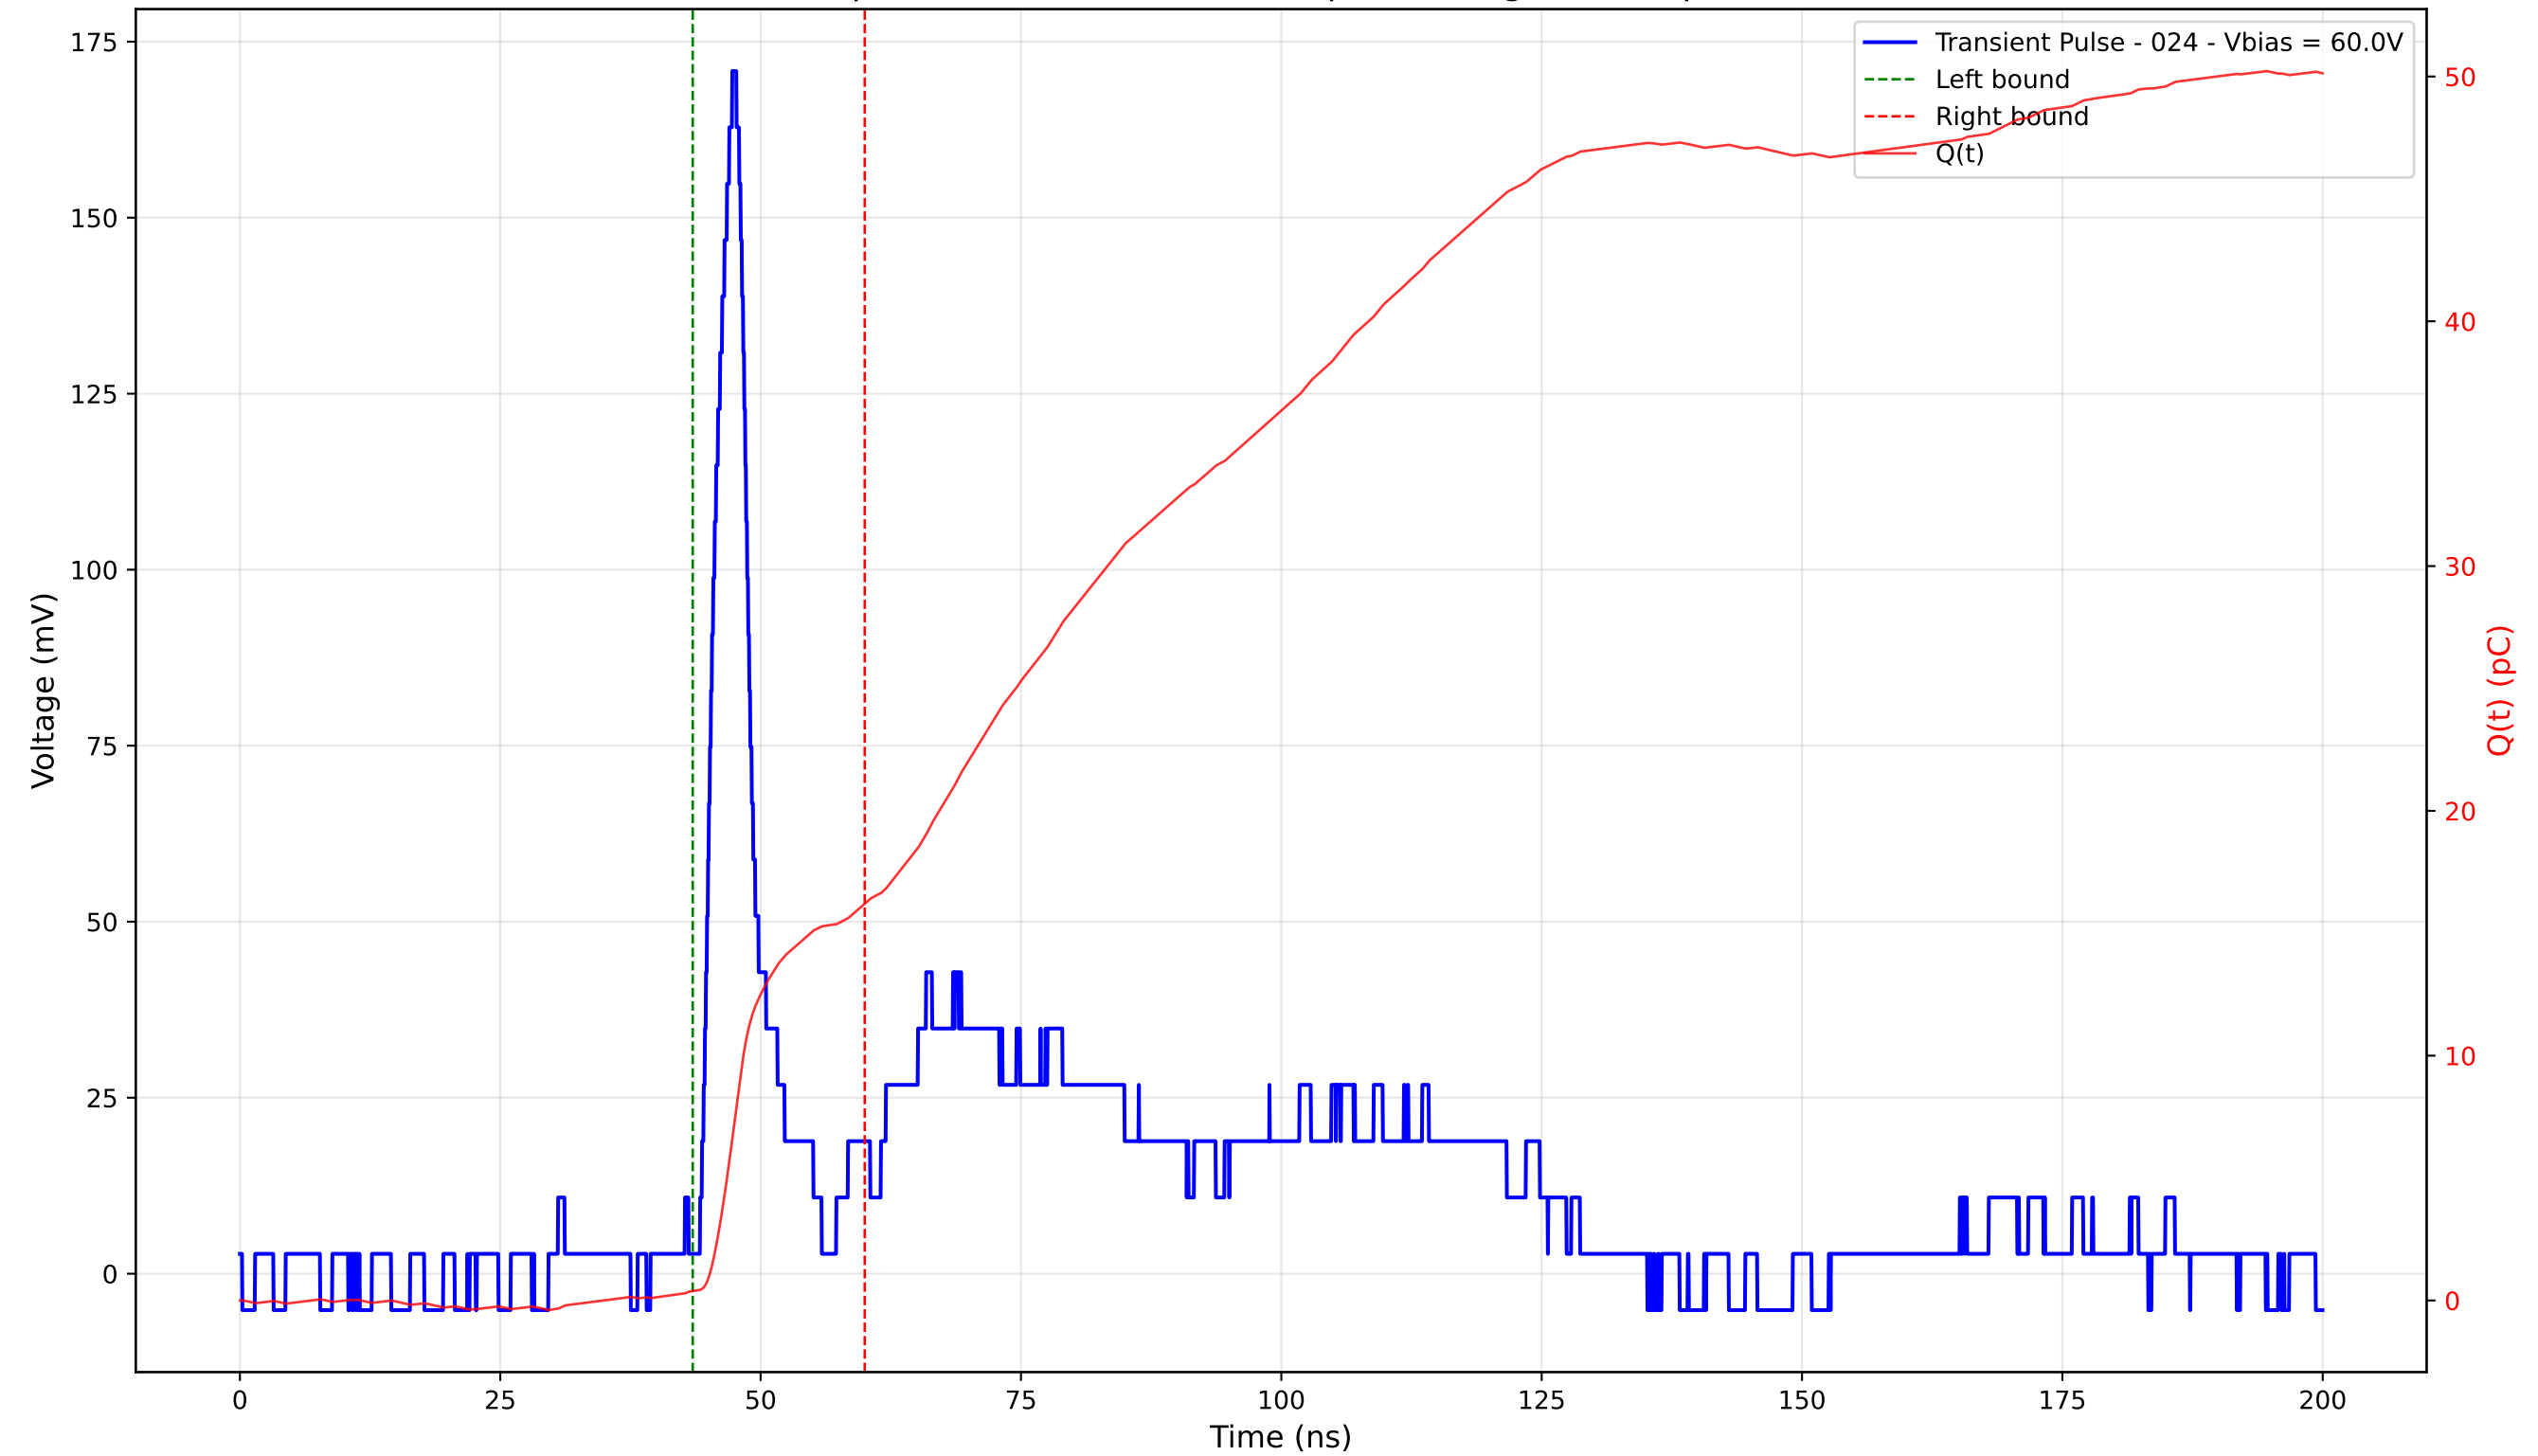


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 14.47 pC - Rise Time: 2.83 ns

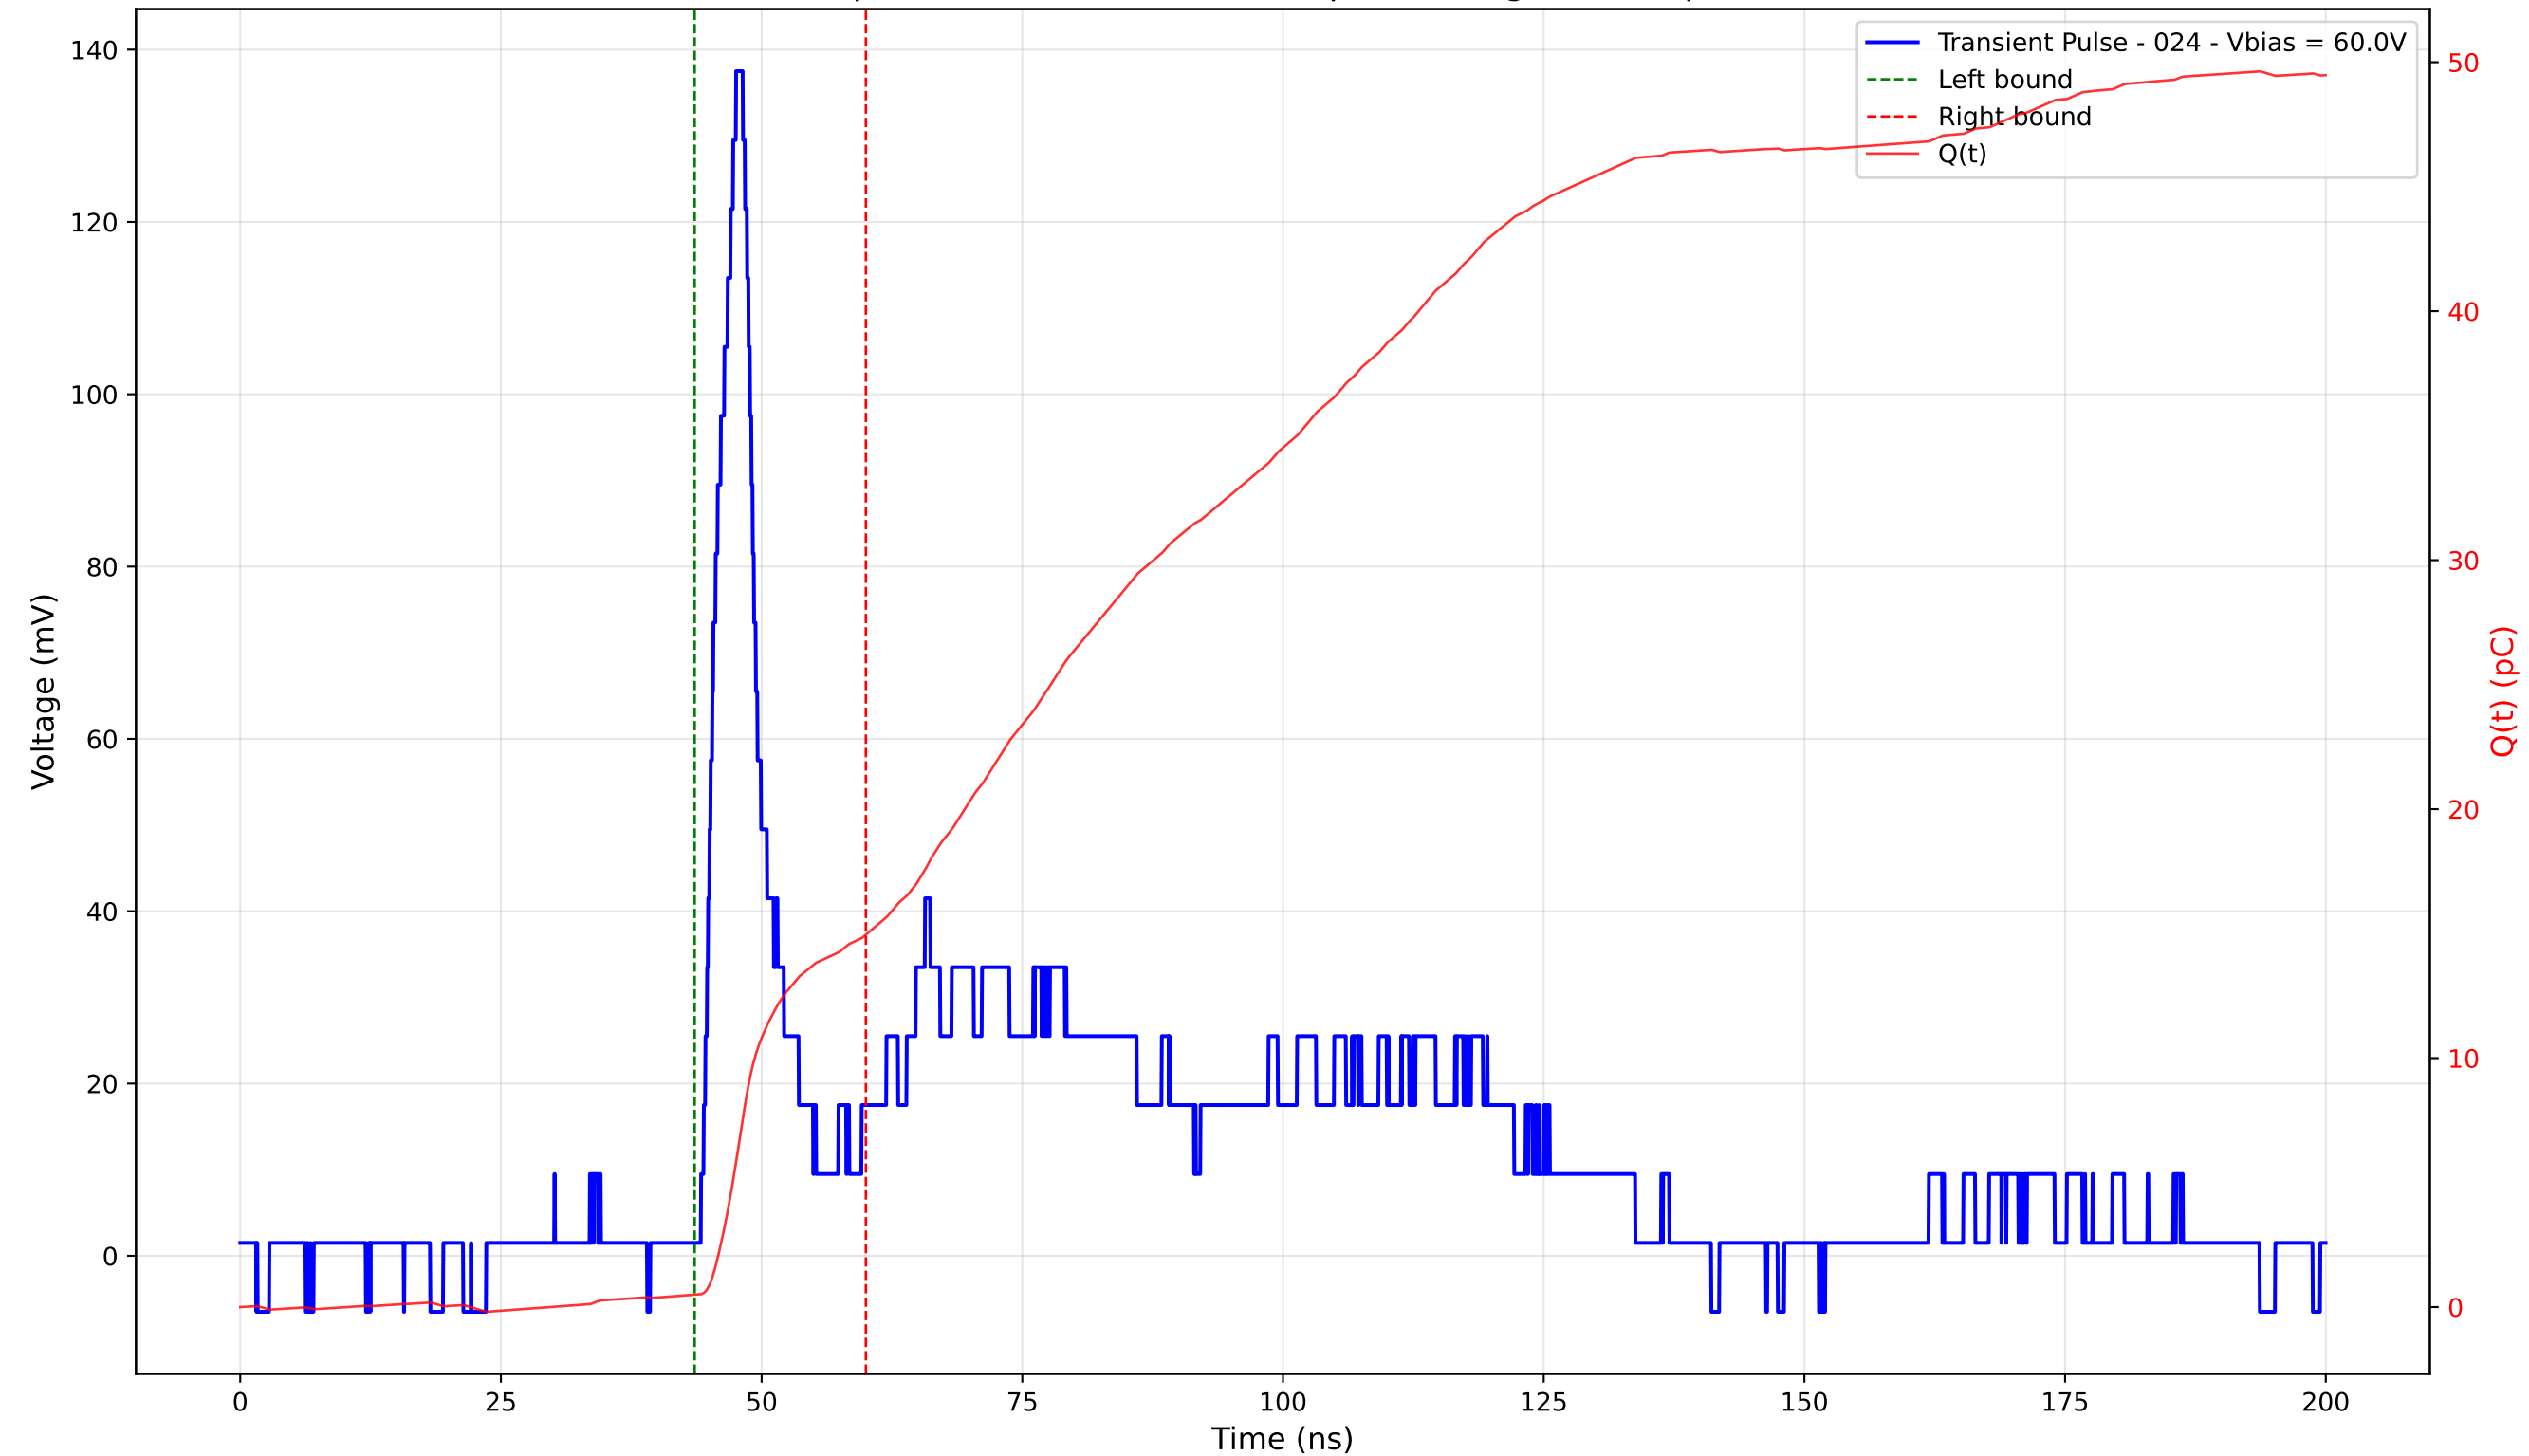


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 12.96 pC - Rise Time: 3.41 ns

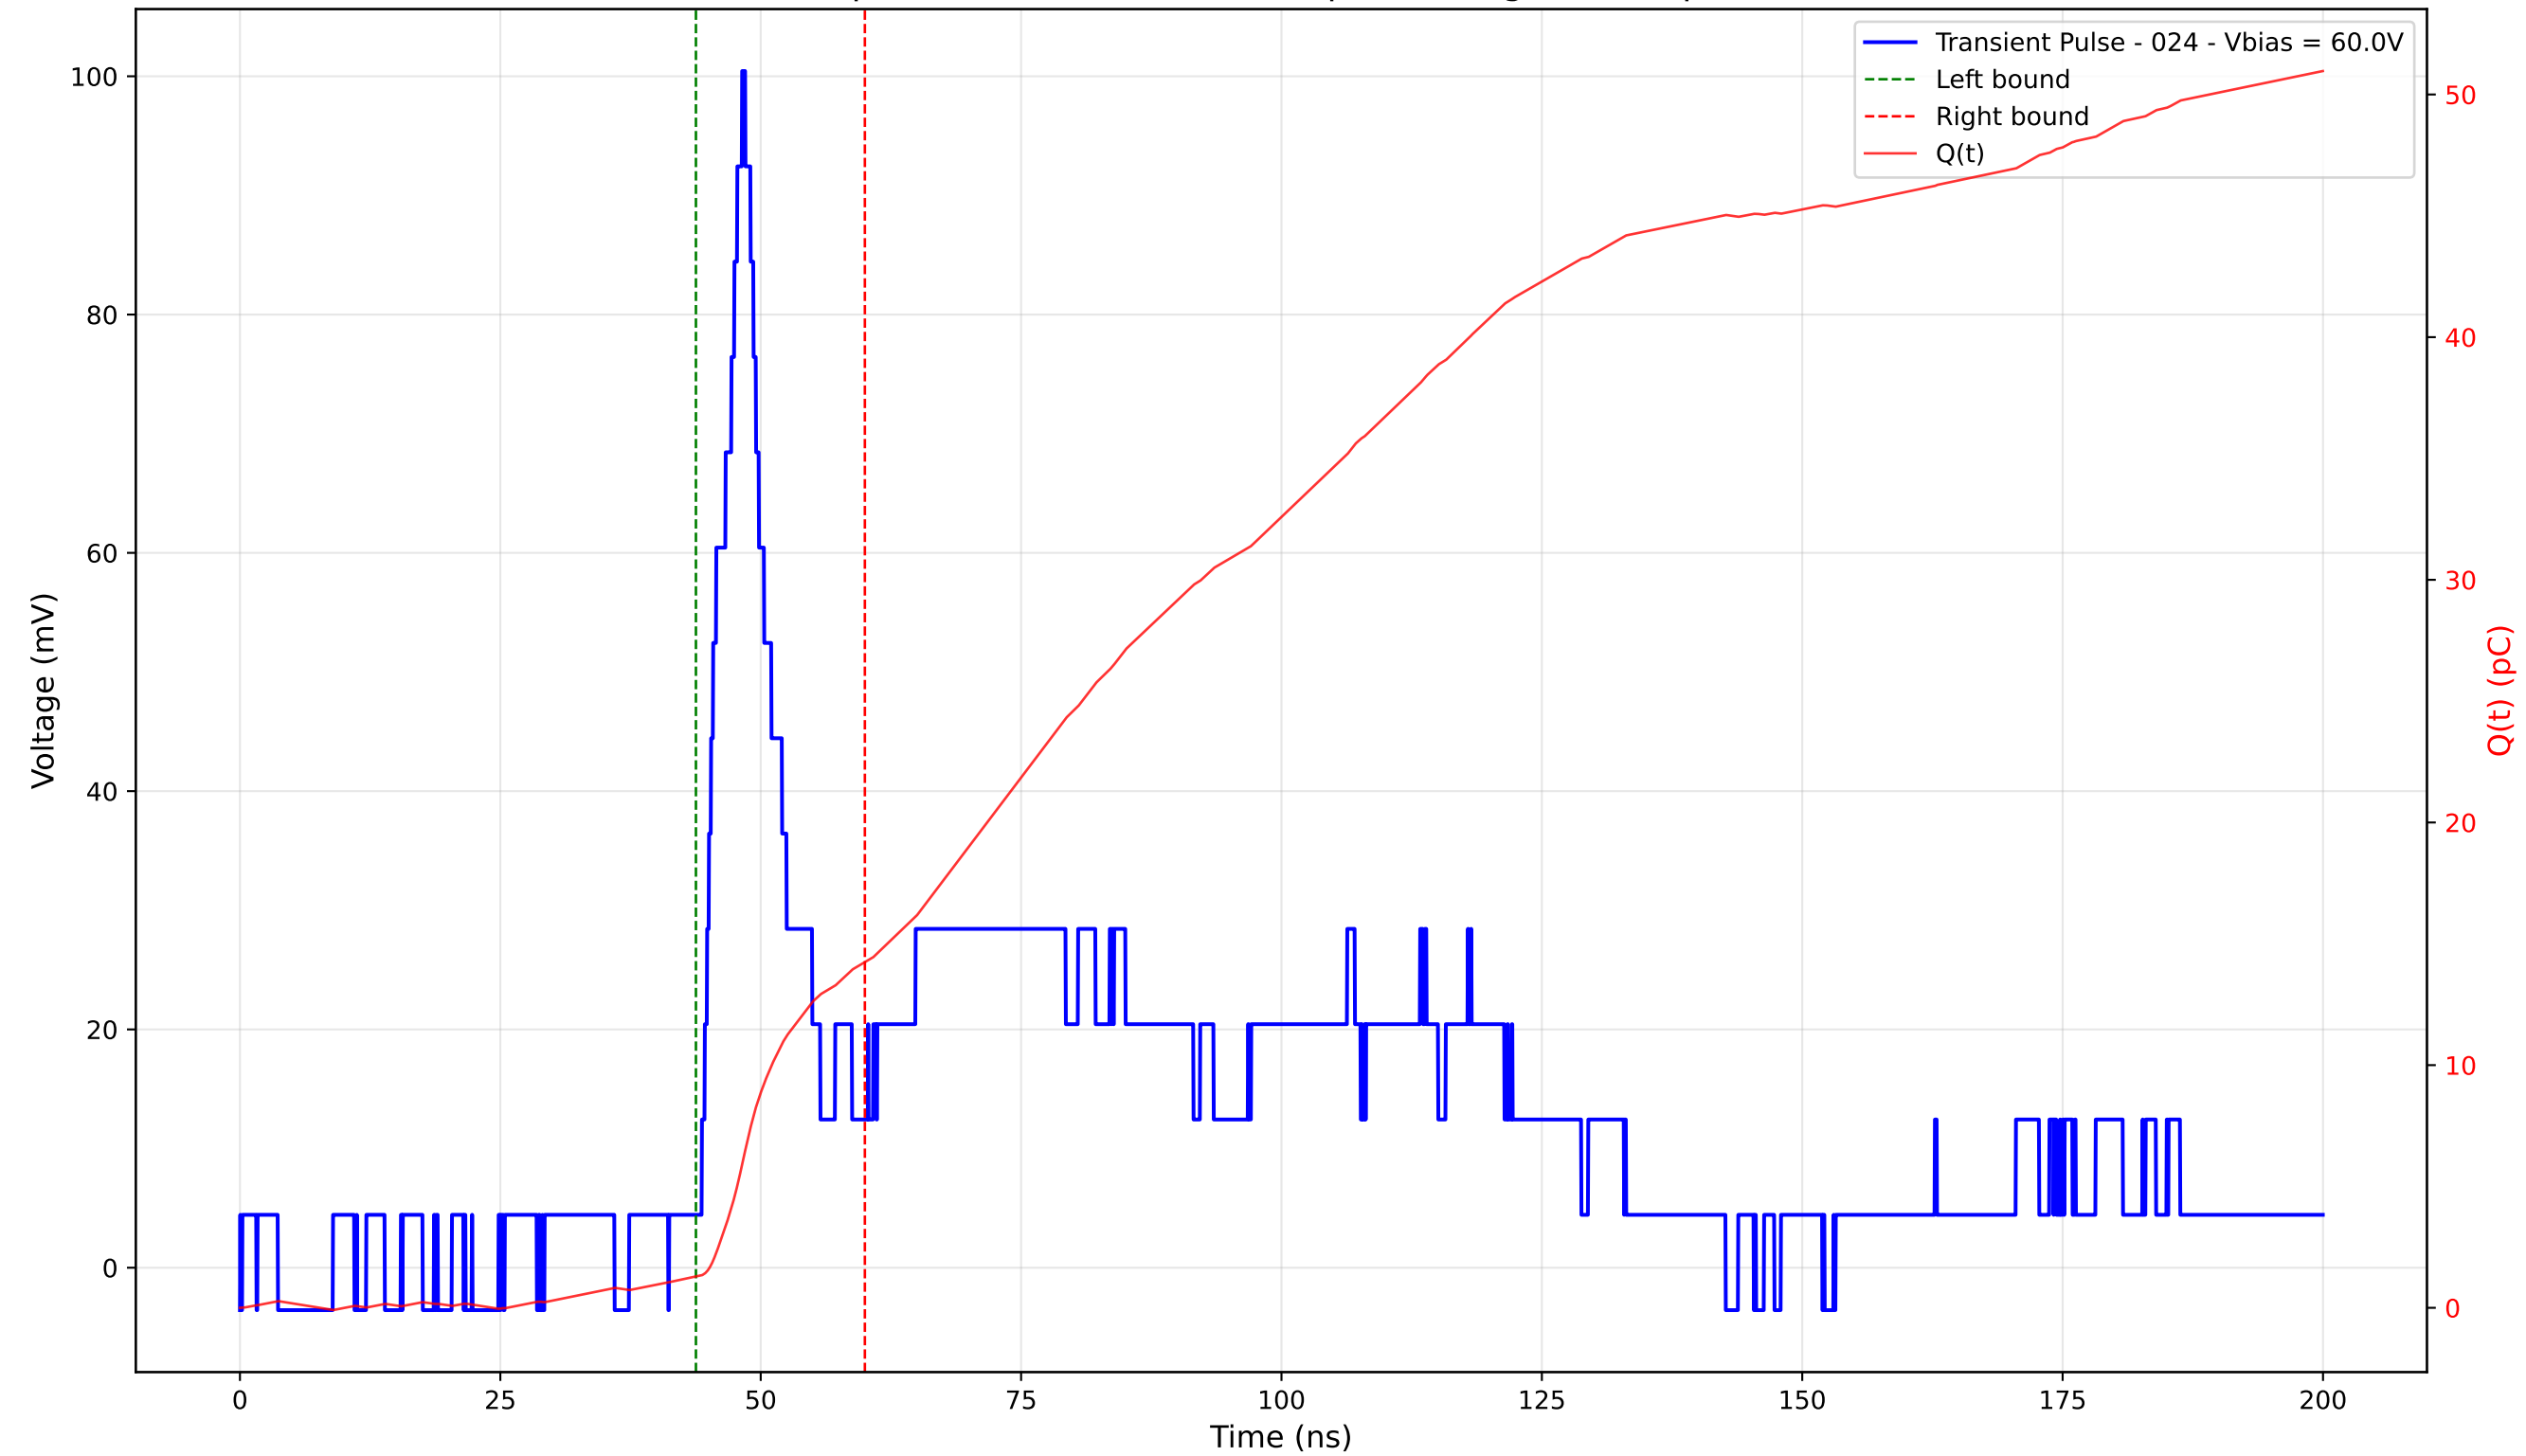


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 10.24 pC - Rise Time: 3.97 ns

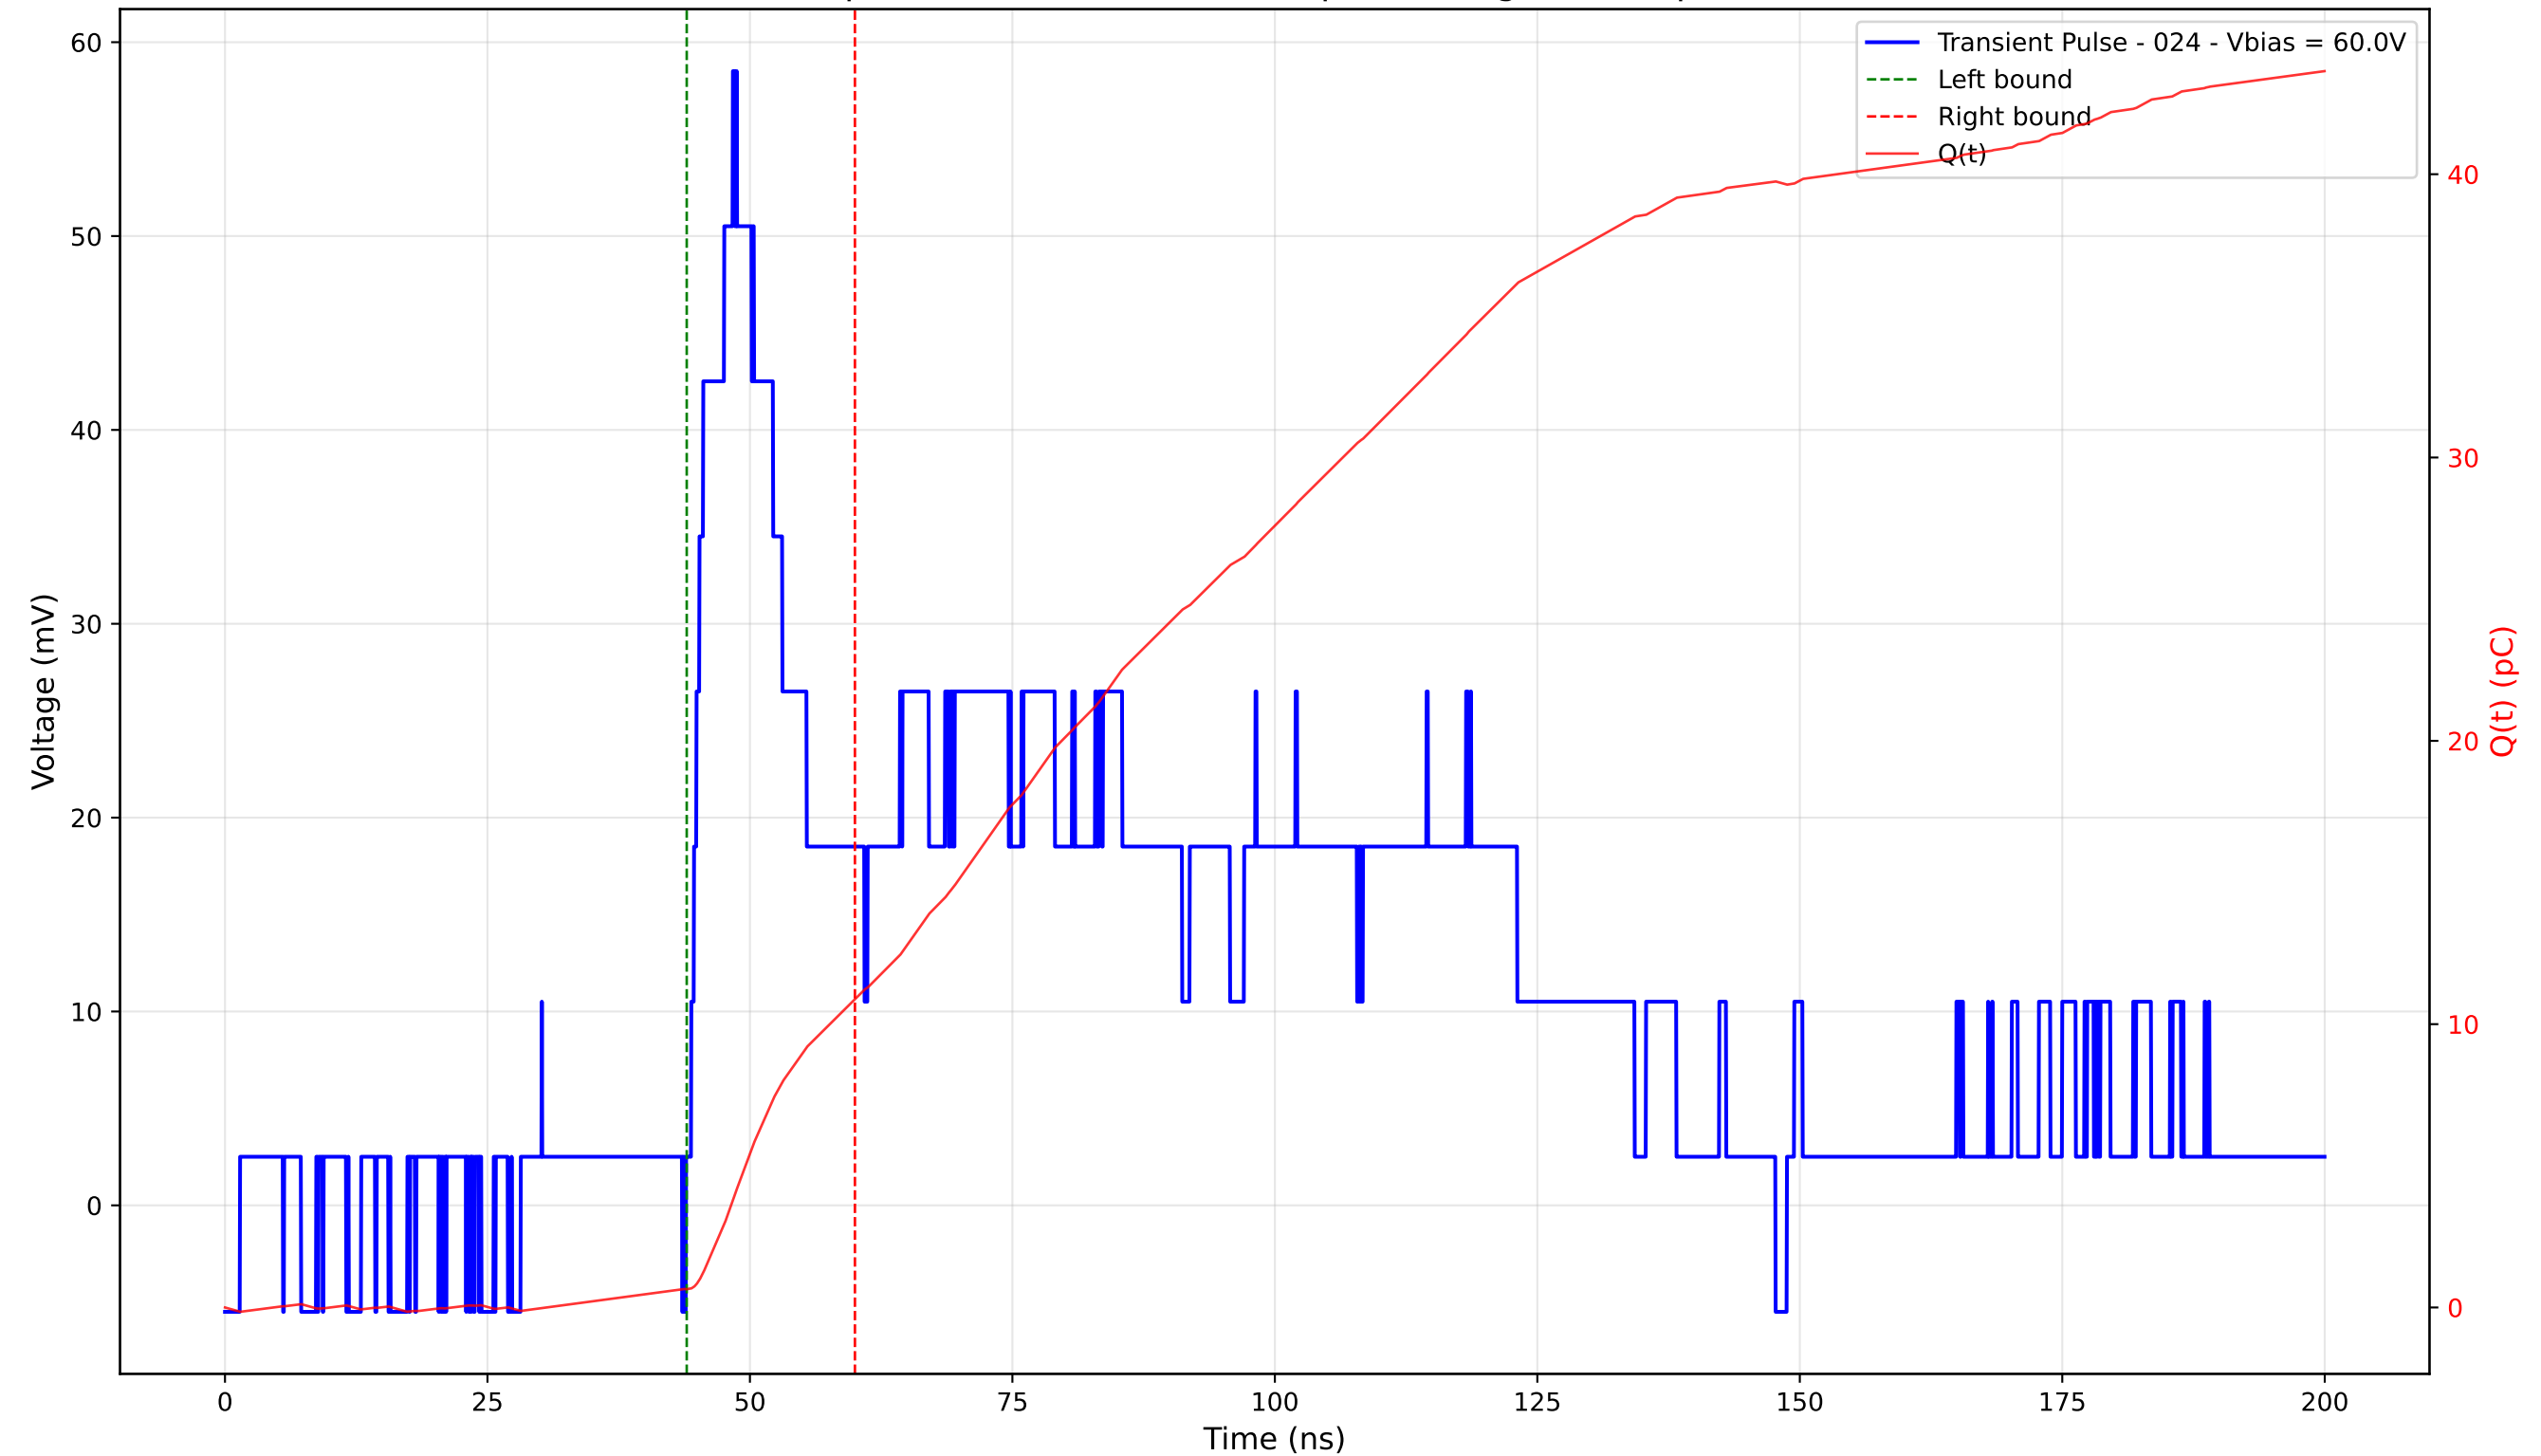


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 7.58 pC - Rise Time: 4.13 ns

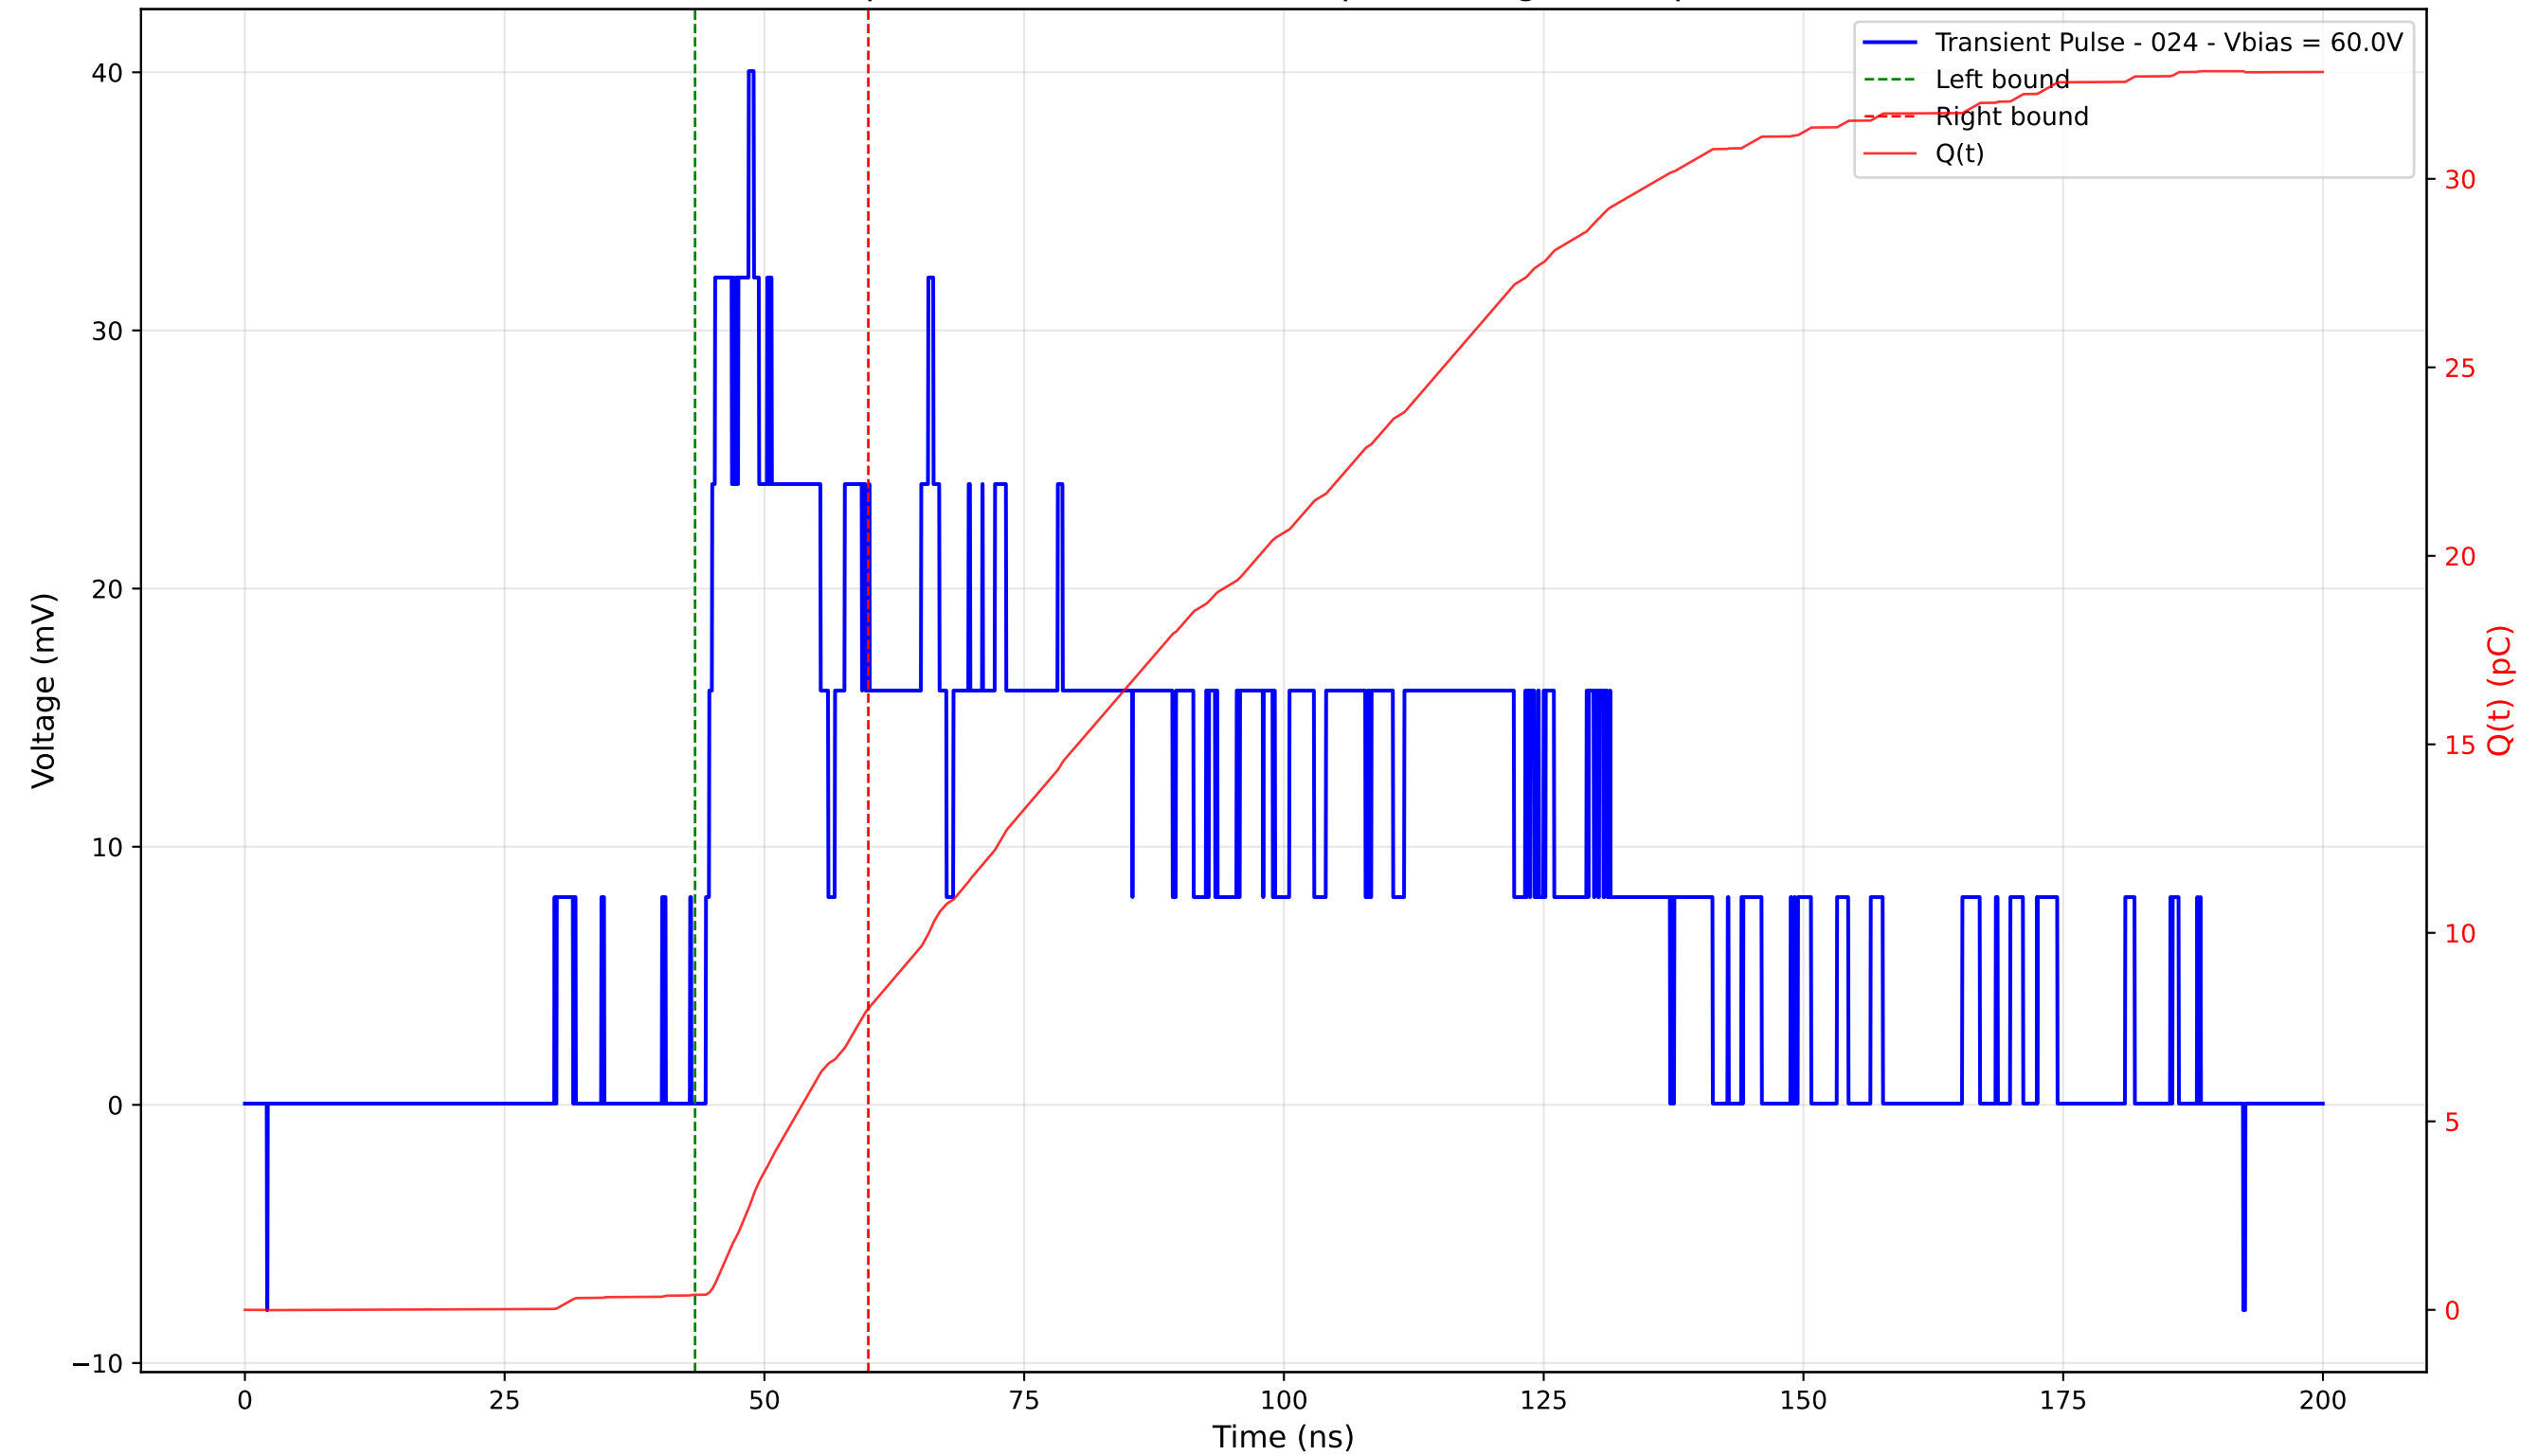


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 5.64 pC - Rise Time: 1.56 ns

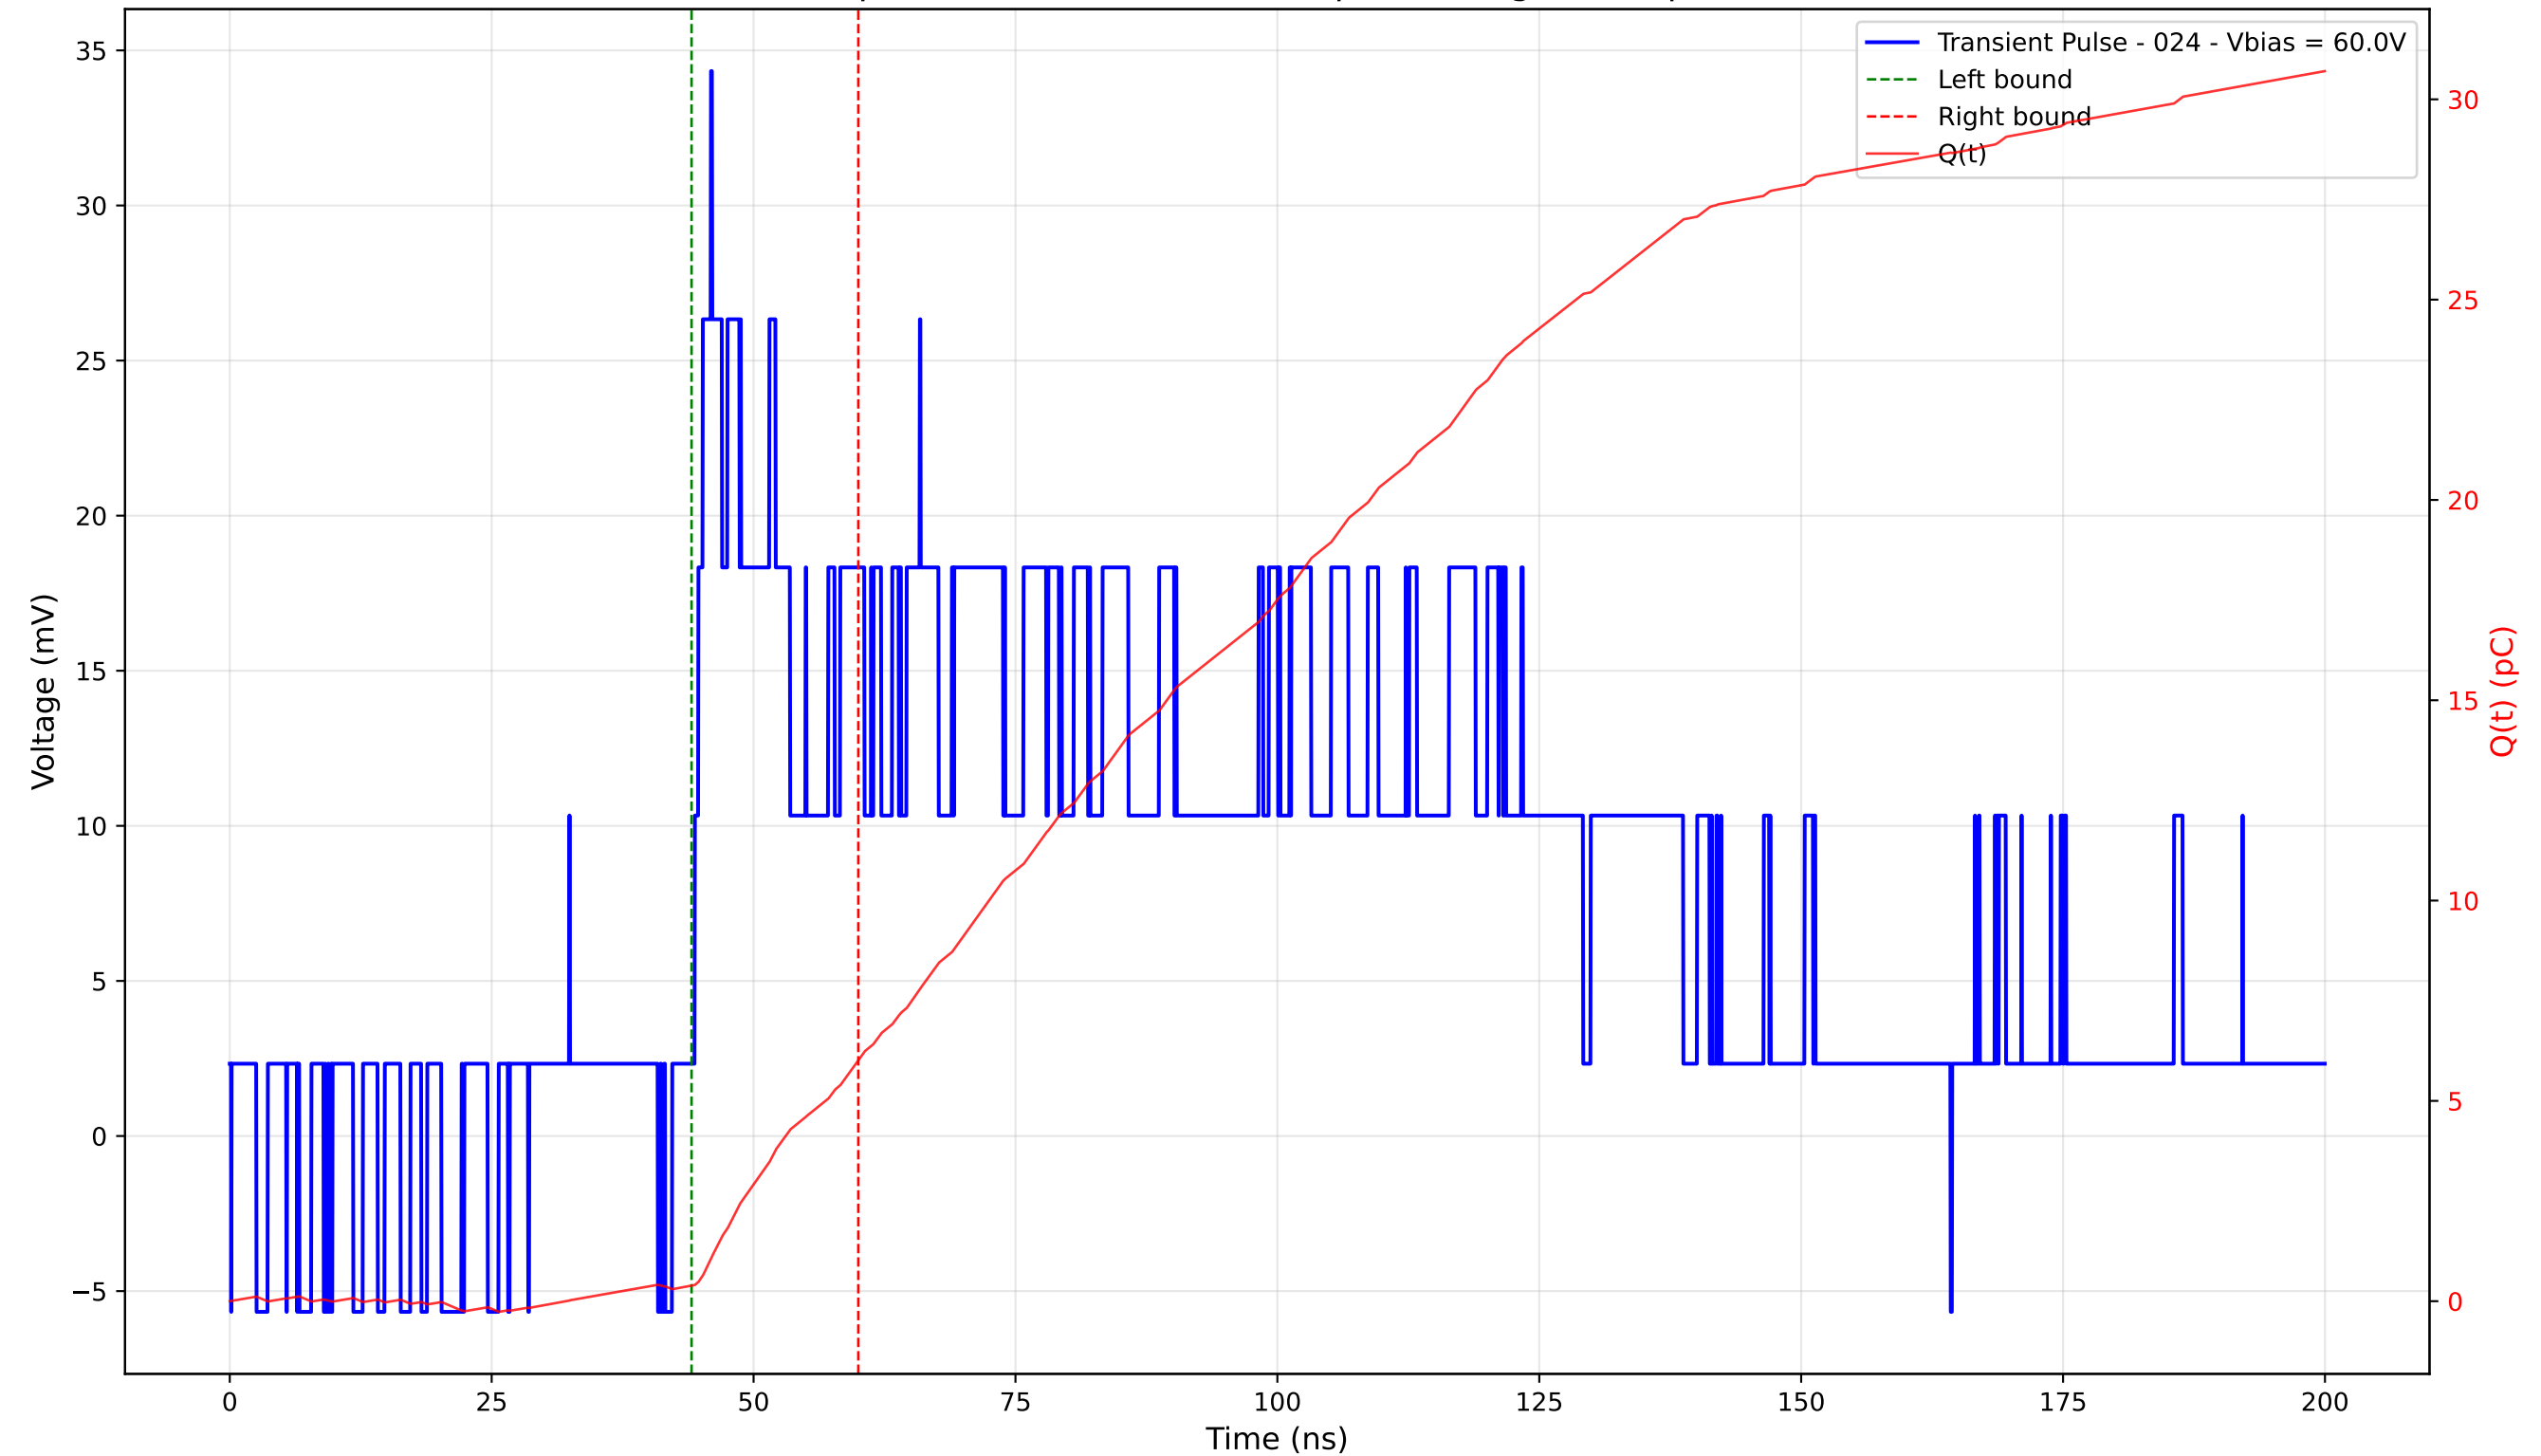


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 4.54 pC - Rise Time: 1.01 ns

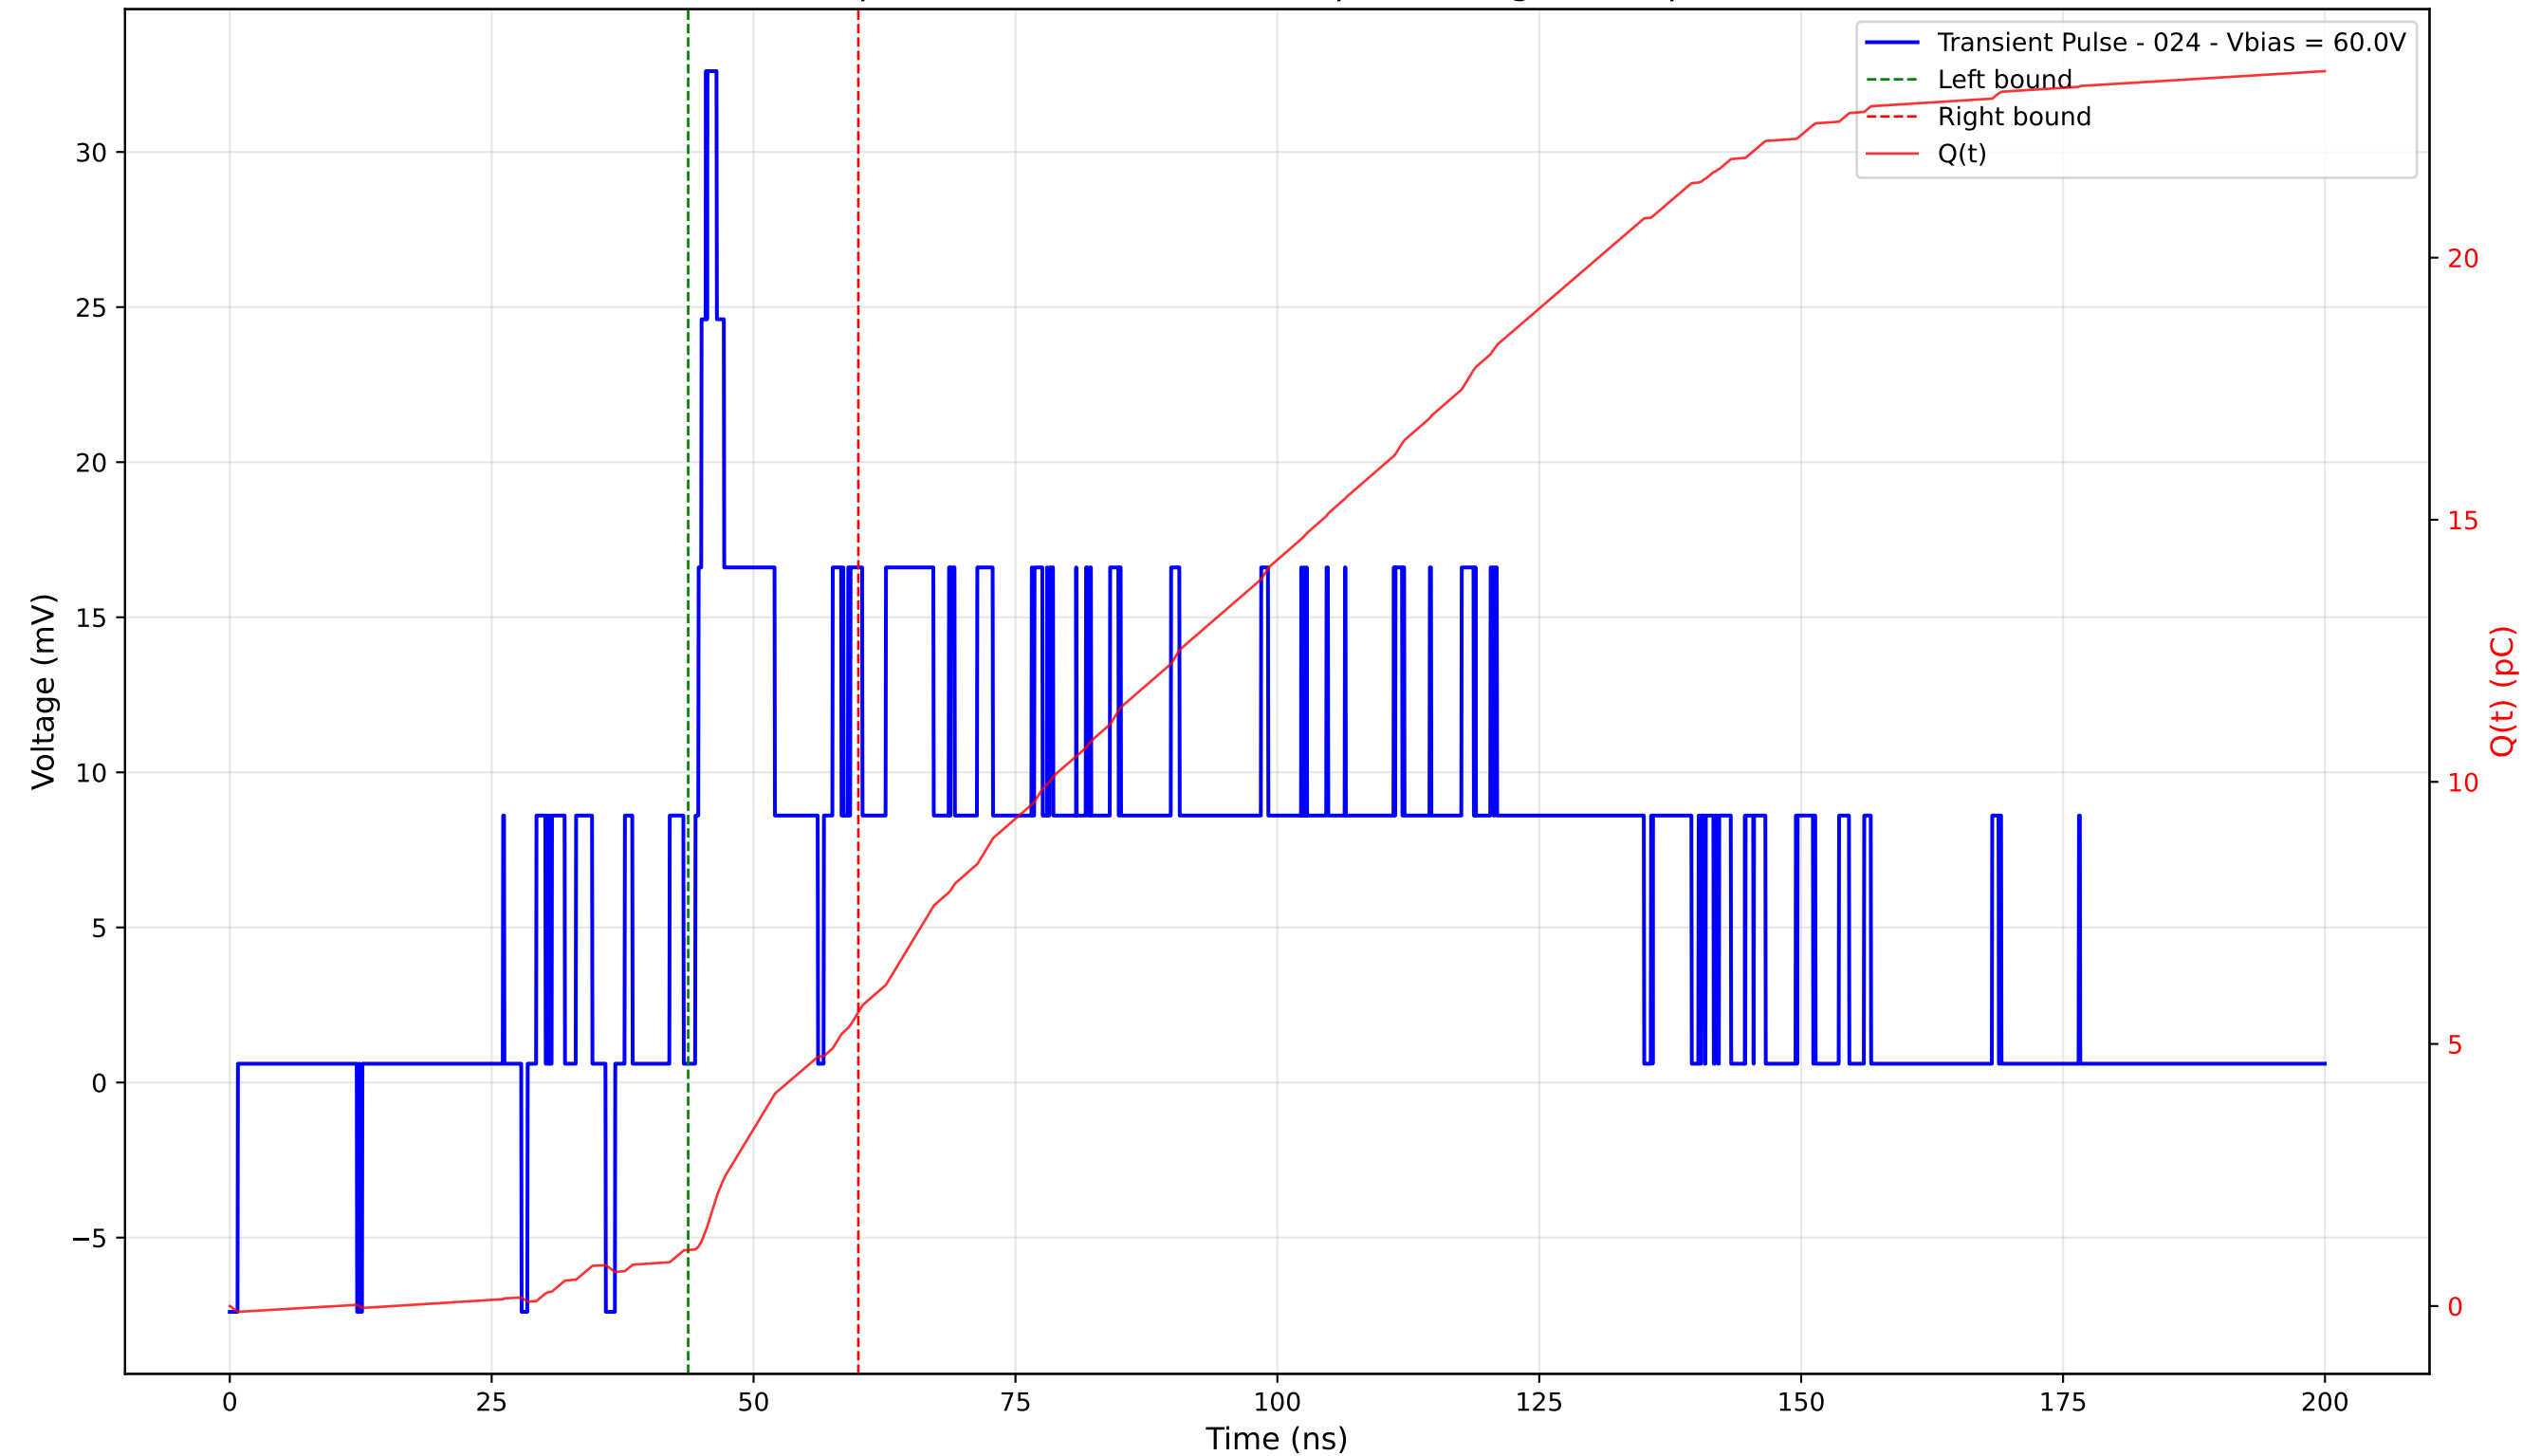


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 4.39 pC - Rise Time: 0.00 ns (N/A)

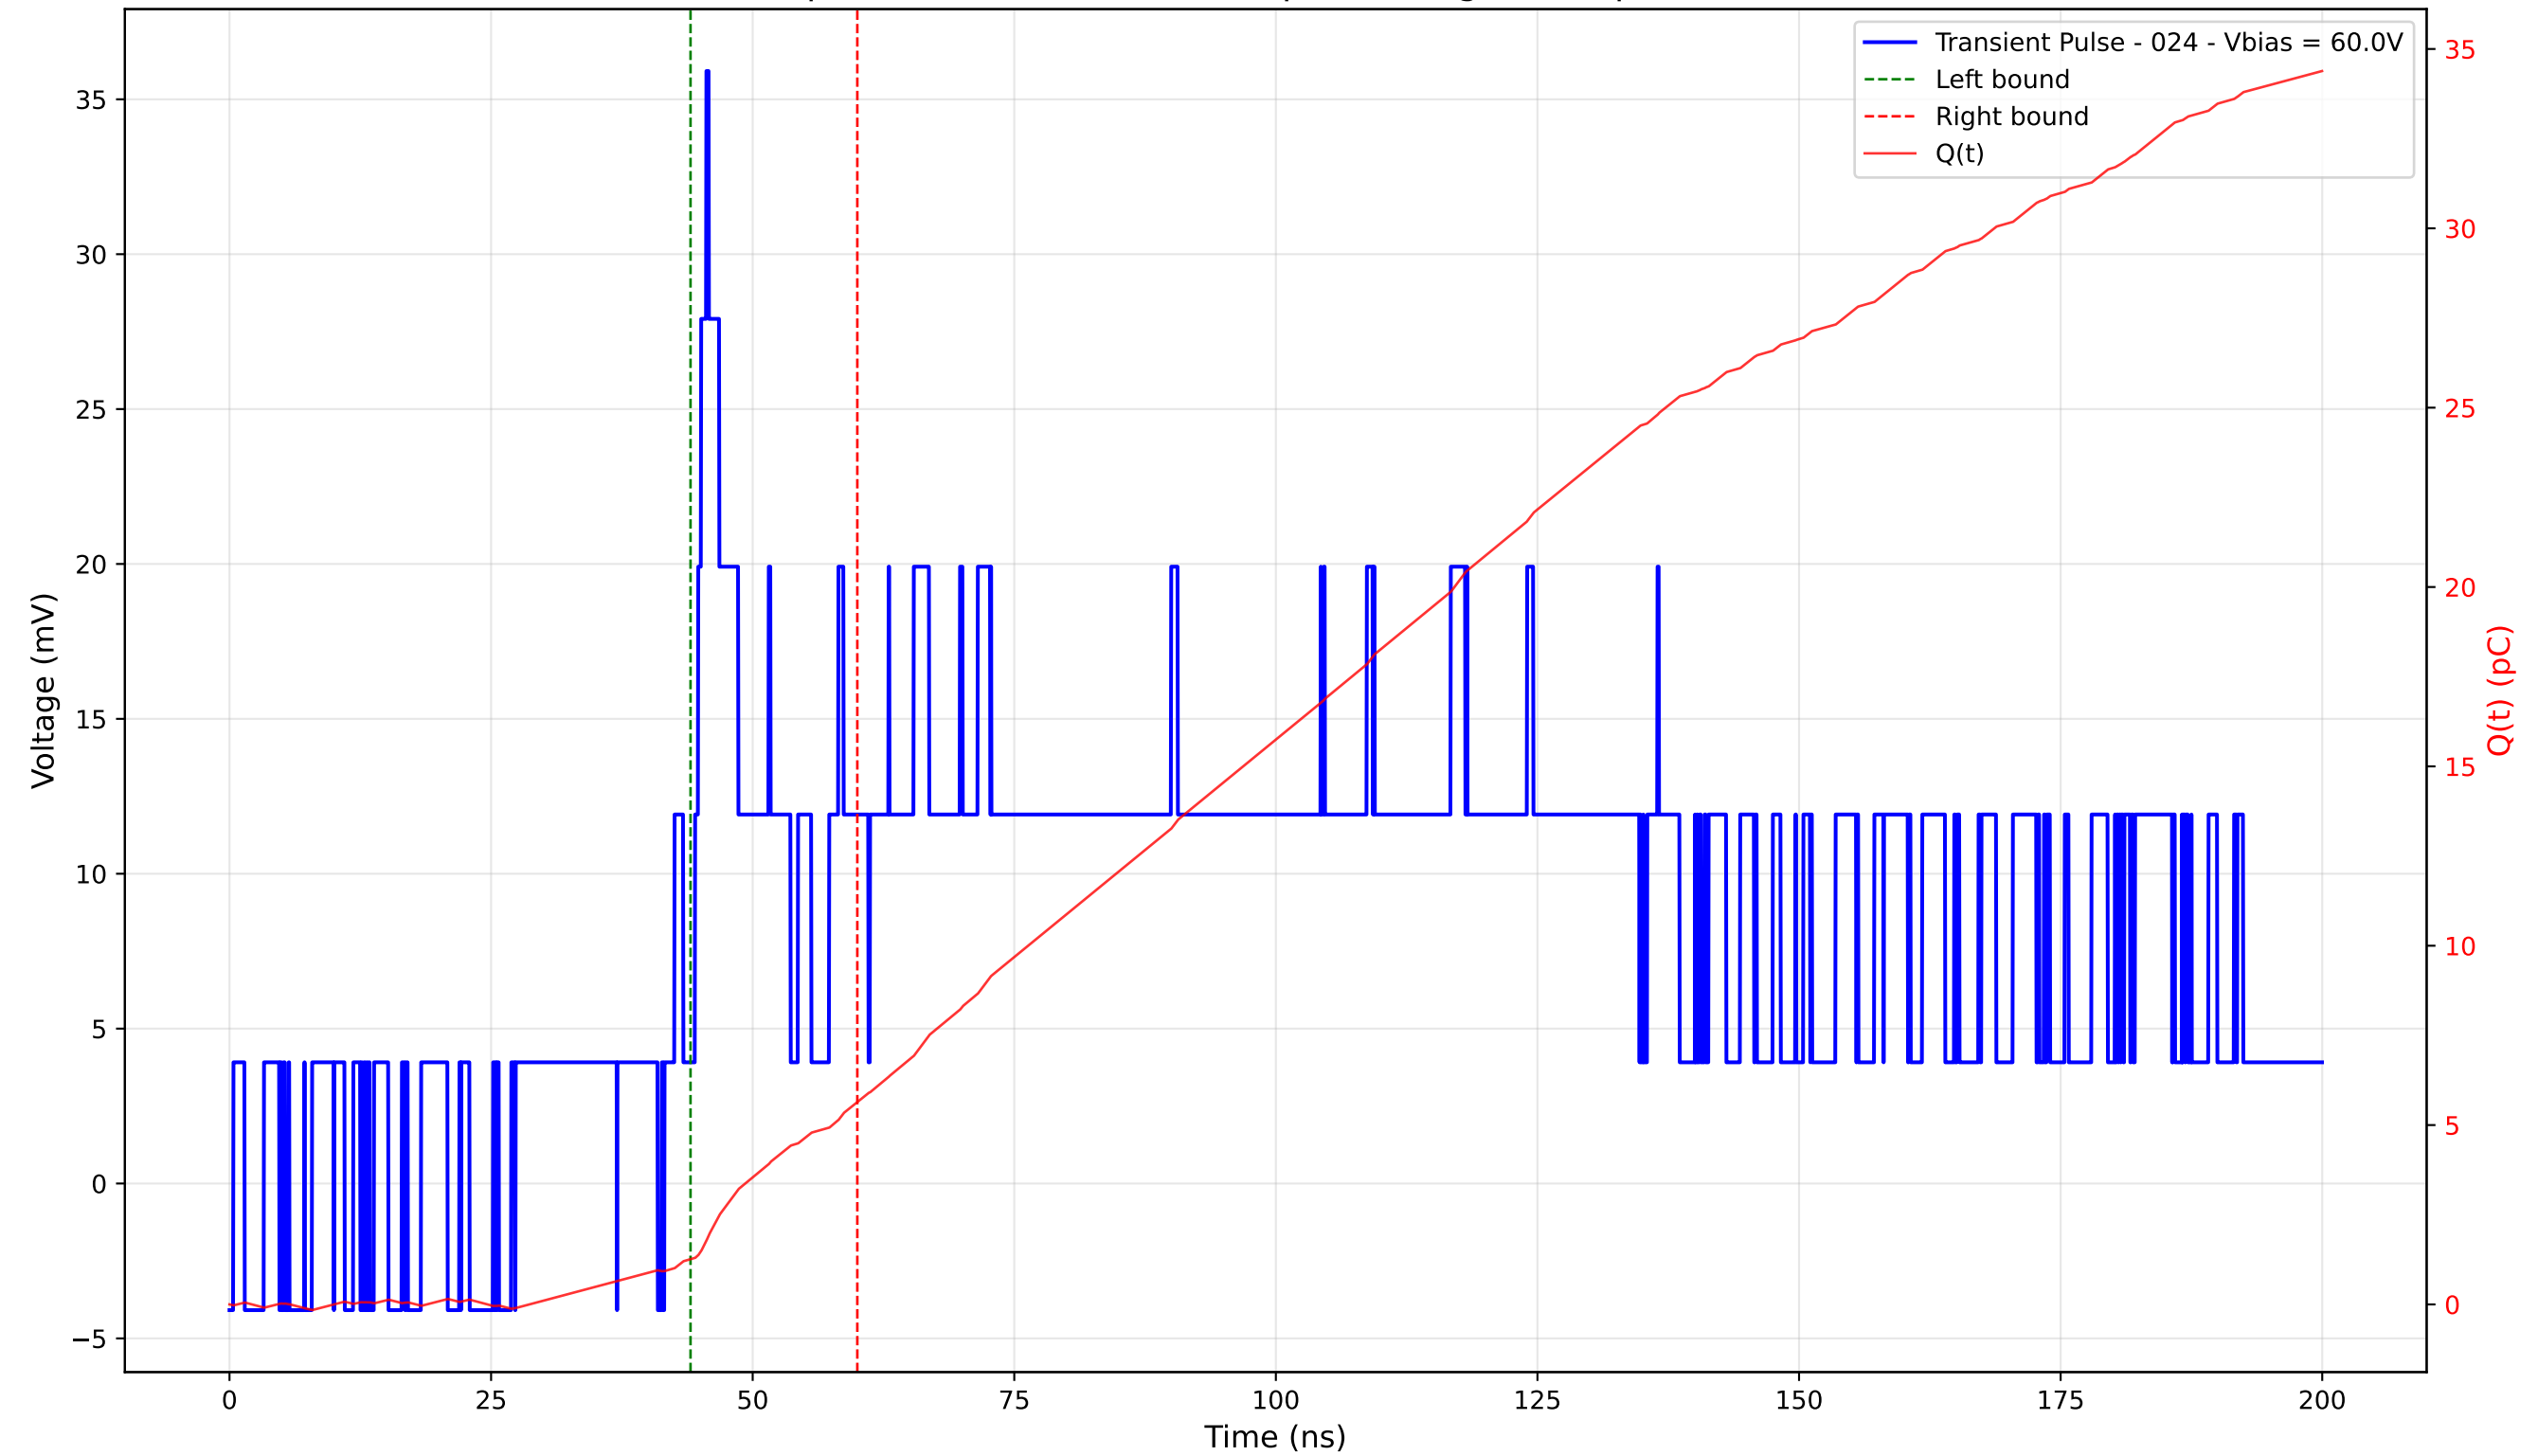


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 2.96 pC - Rise Time: 0.91 ns

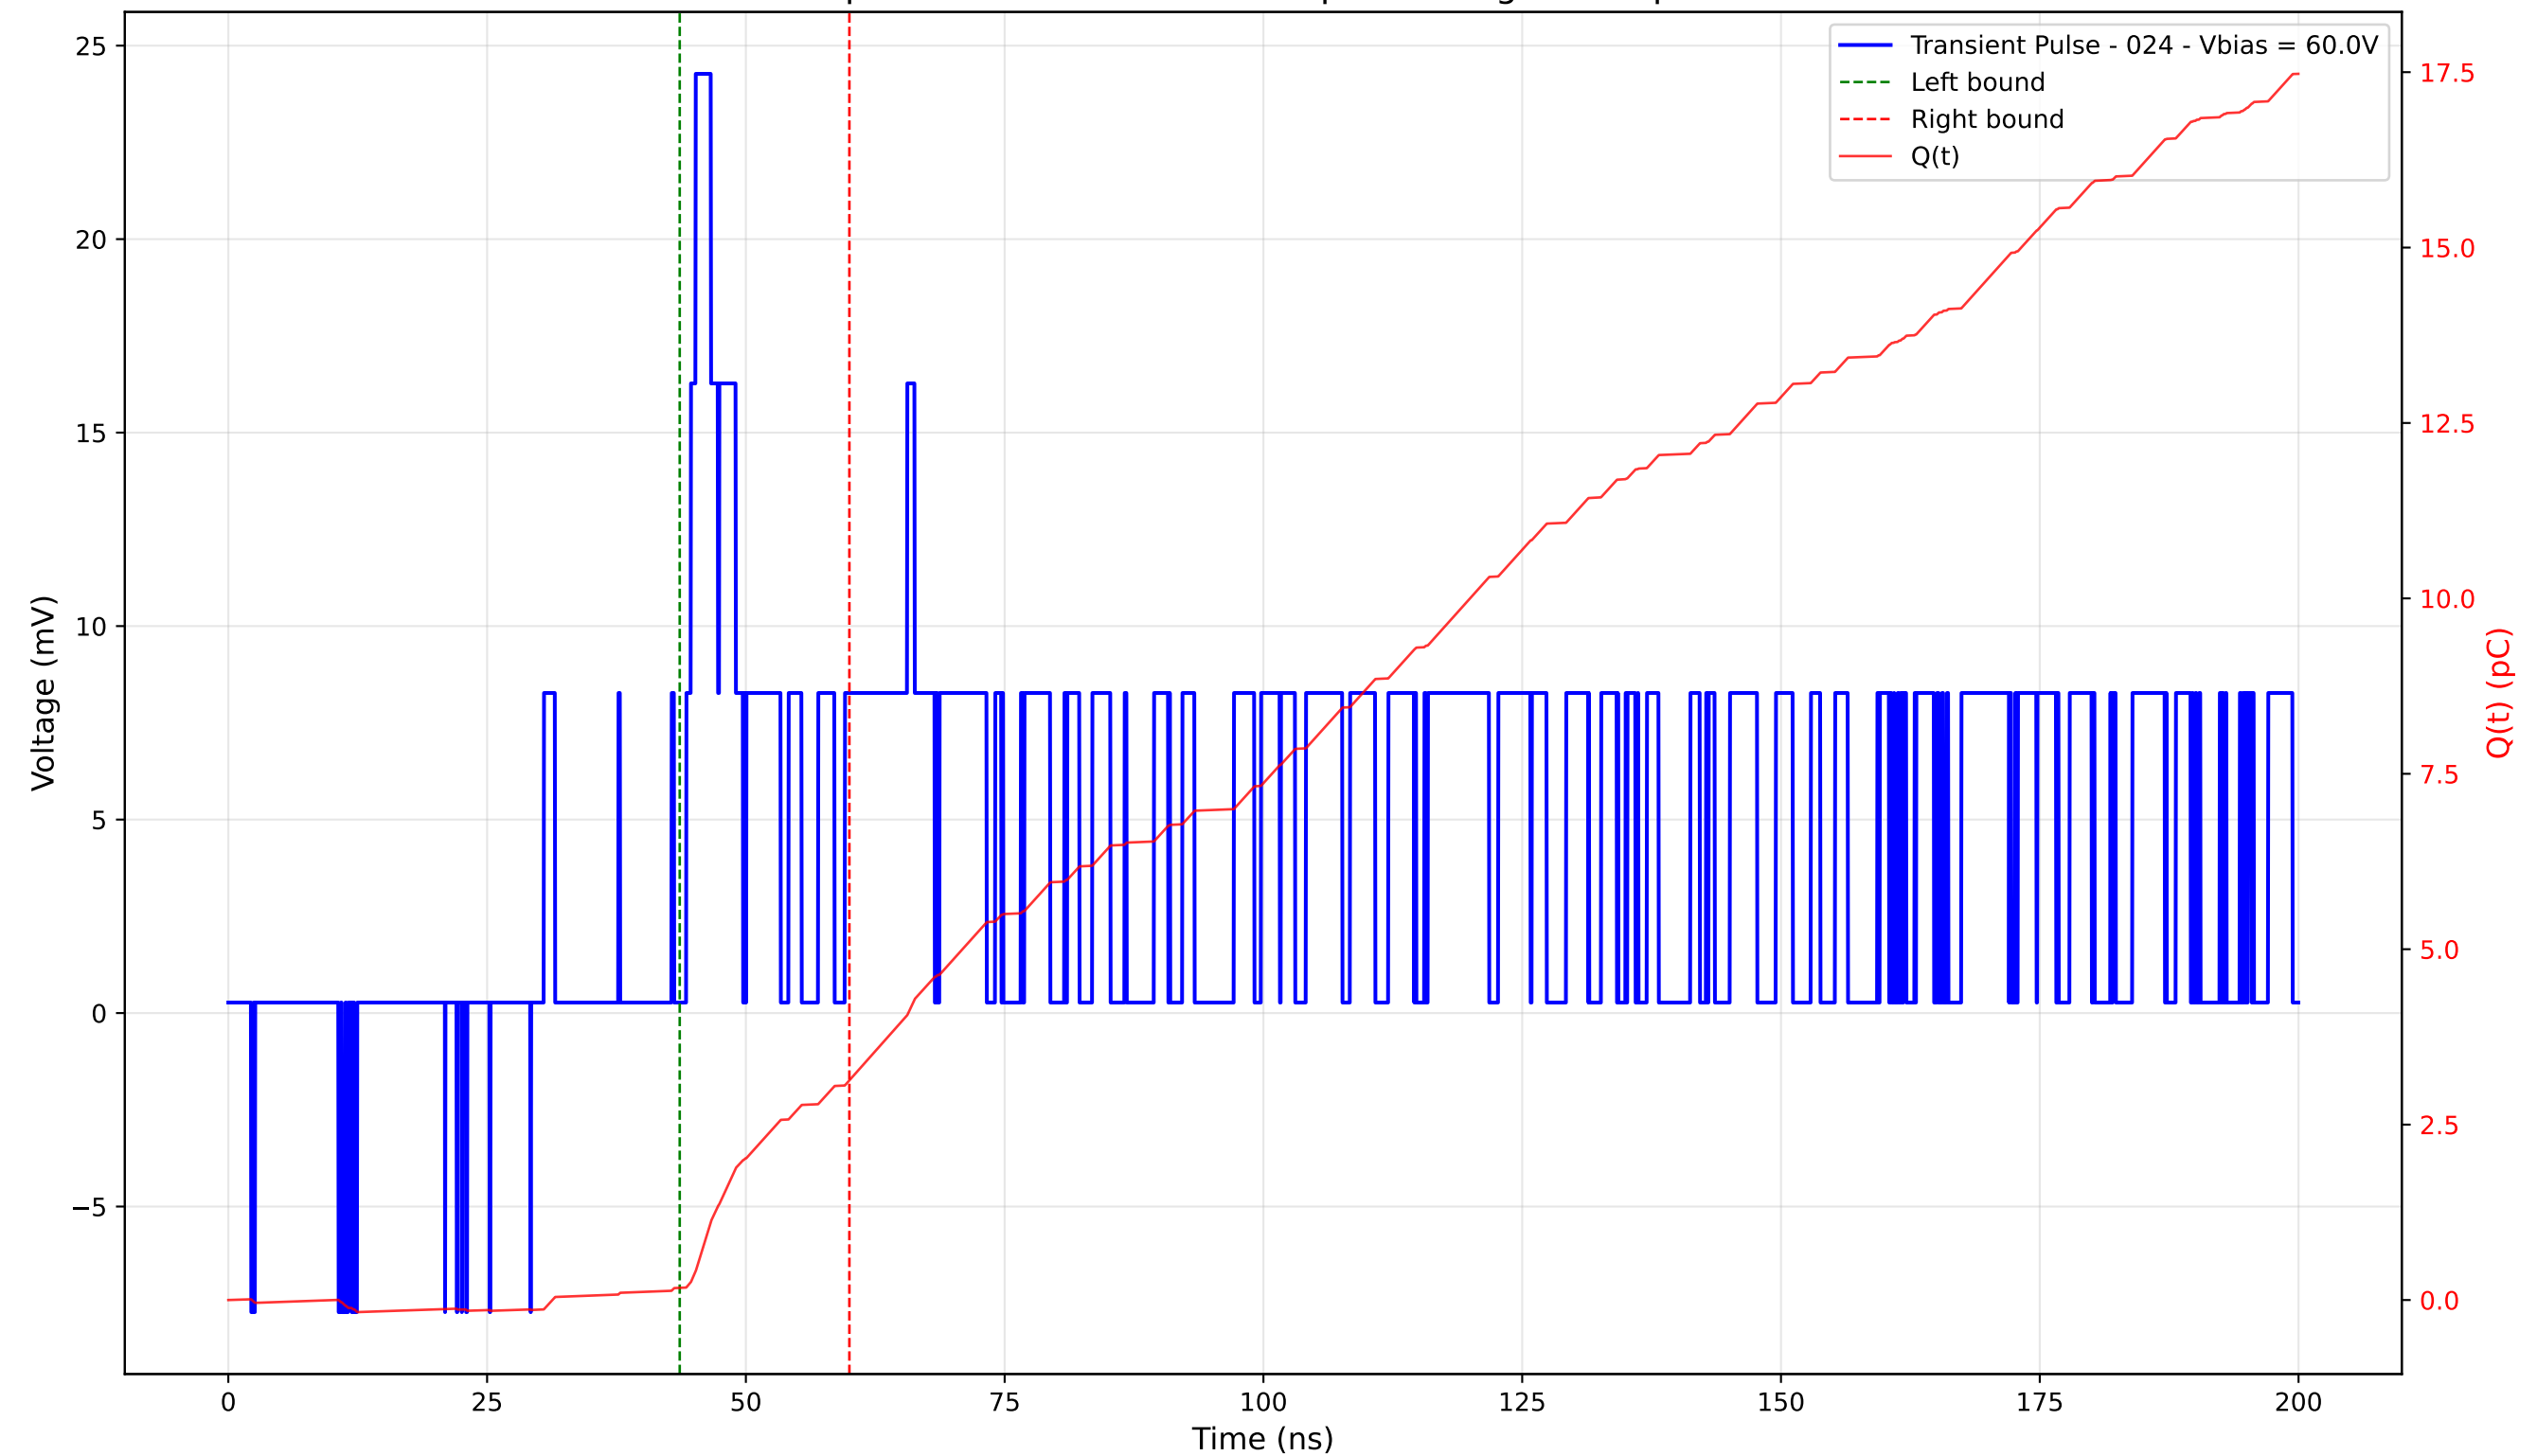


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 3.32 pC - Rise Time: 1.19 ns

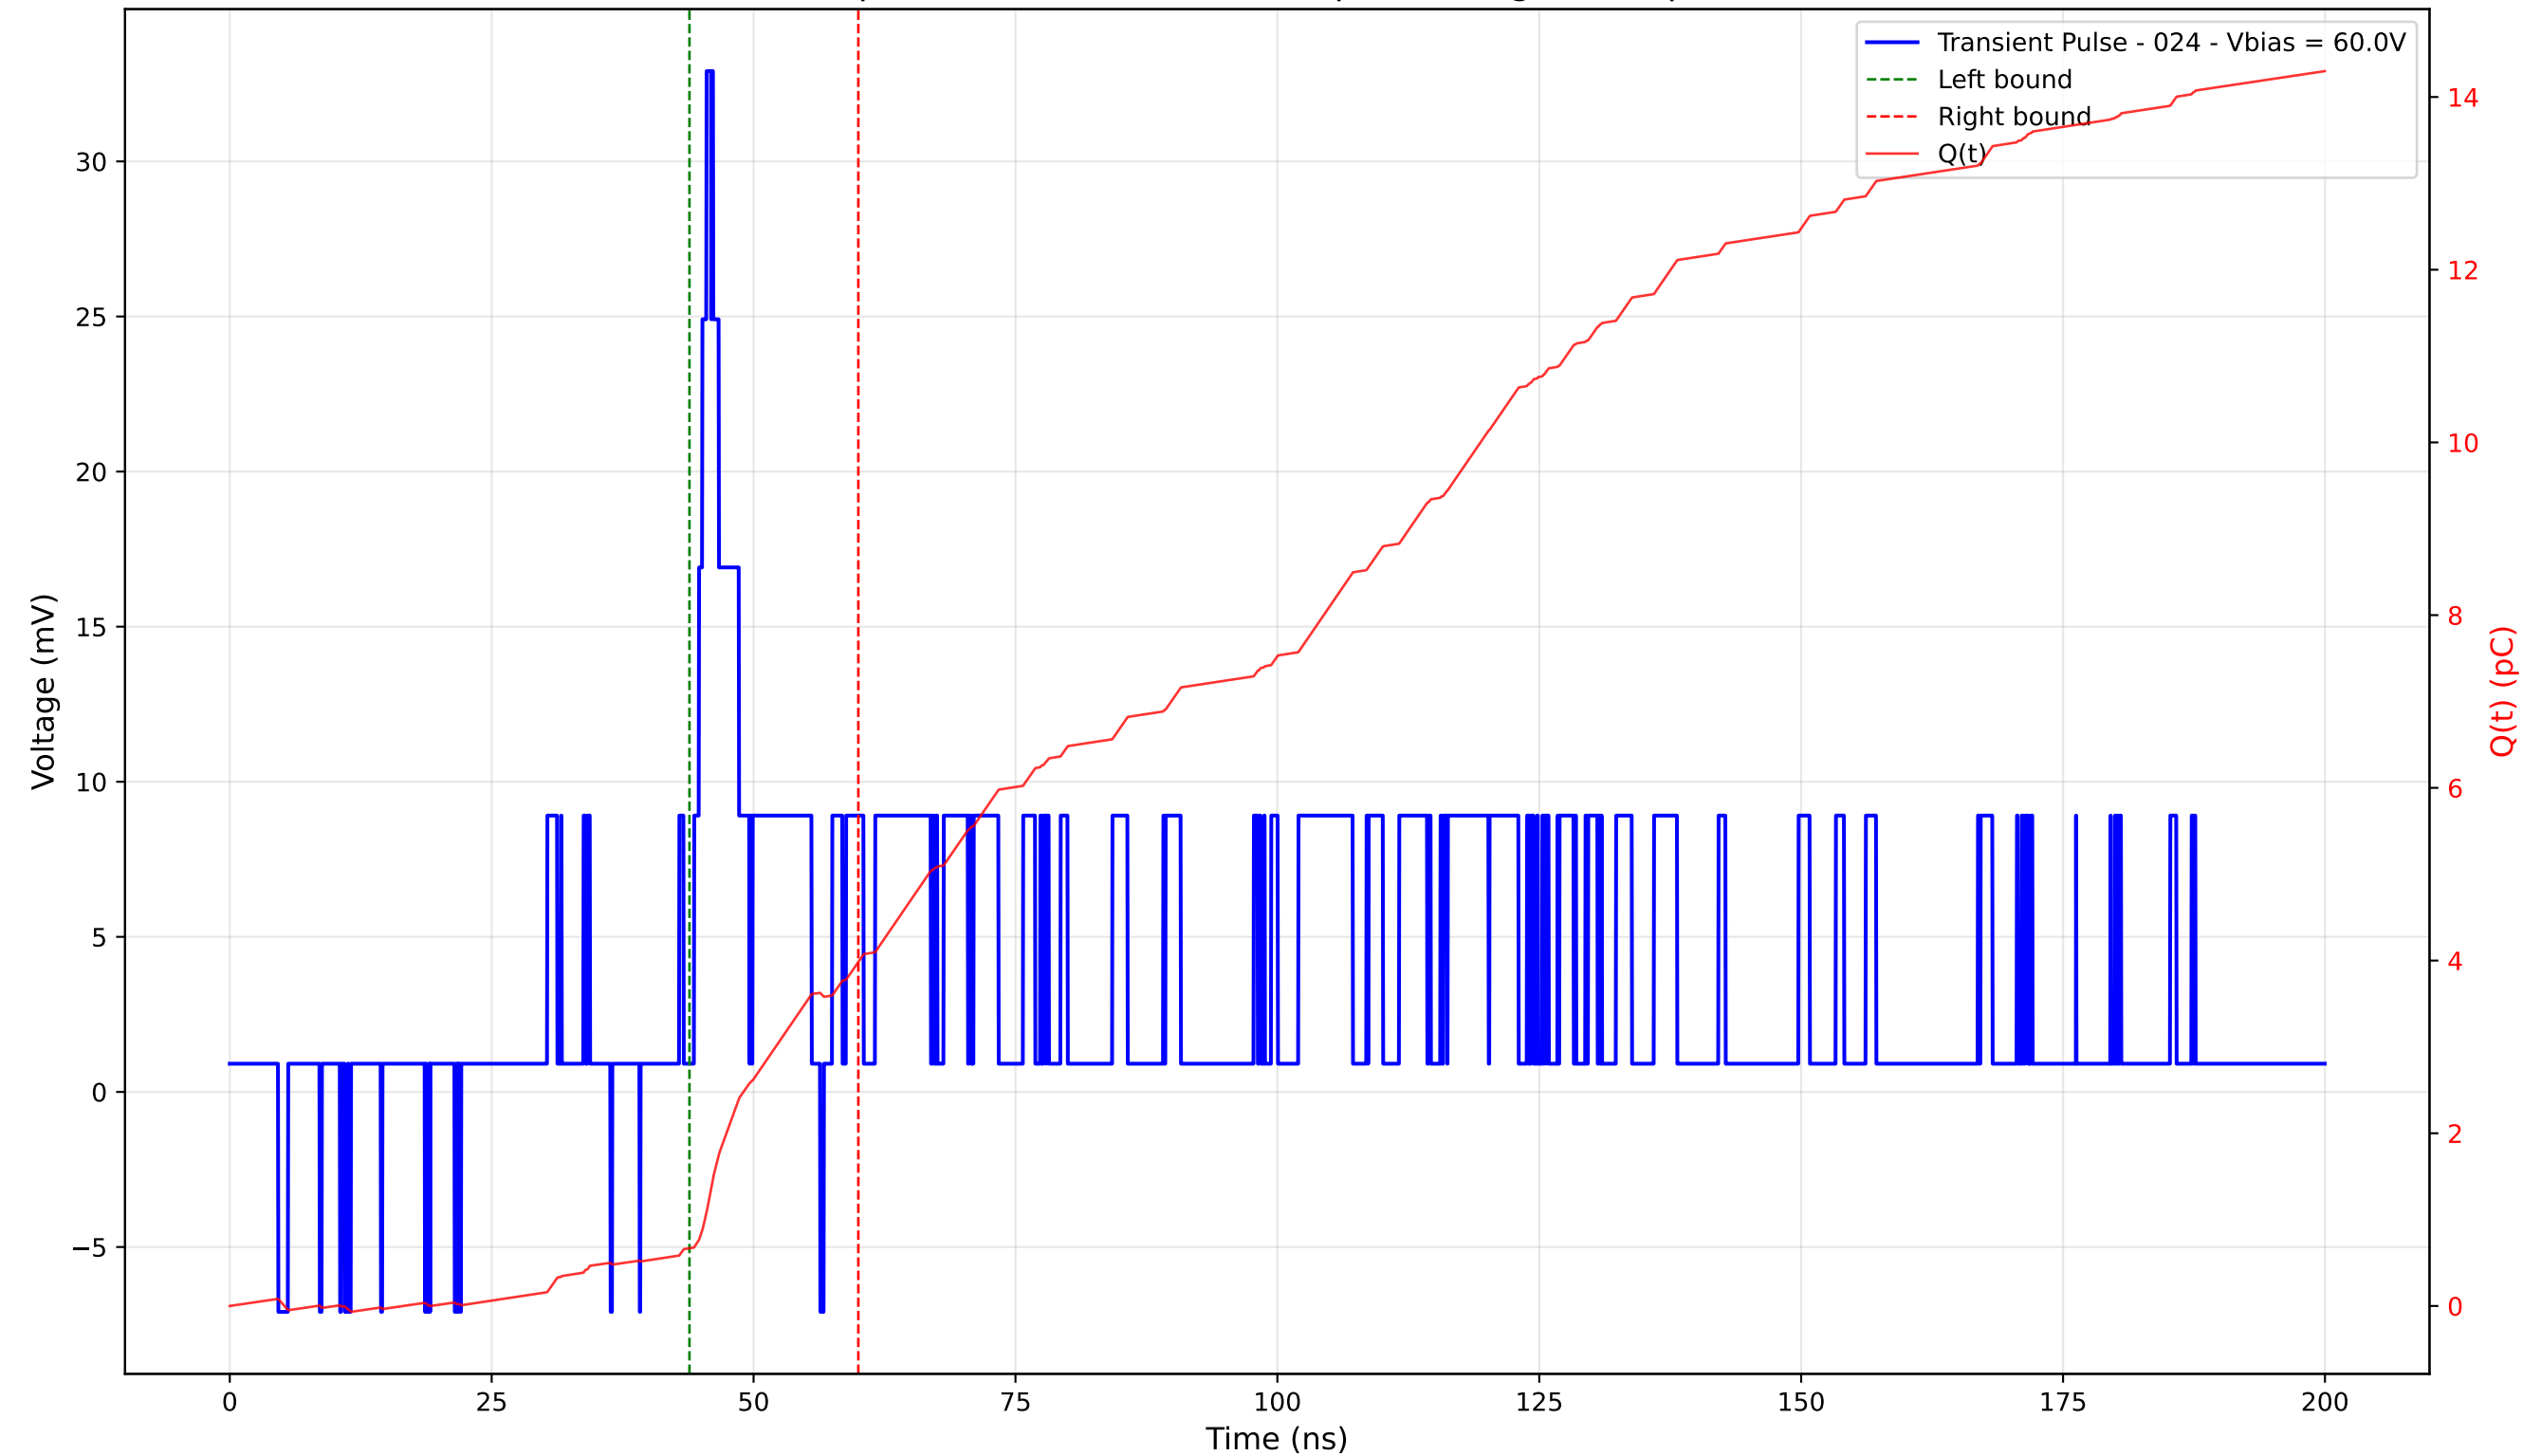


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 3.41 pC - Rise Time: 0.00 ns (N/A)

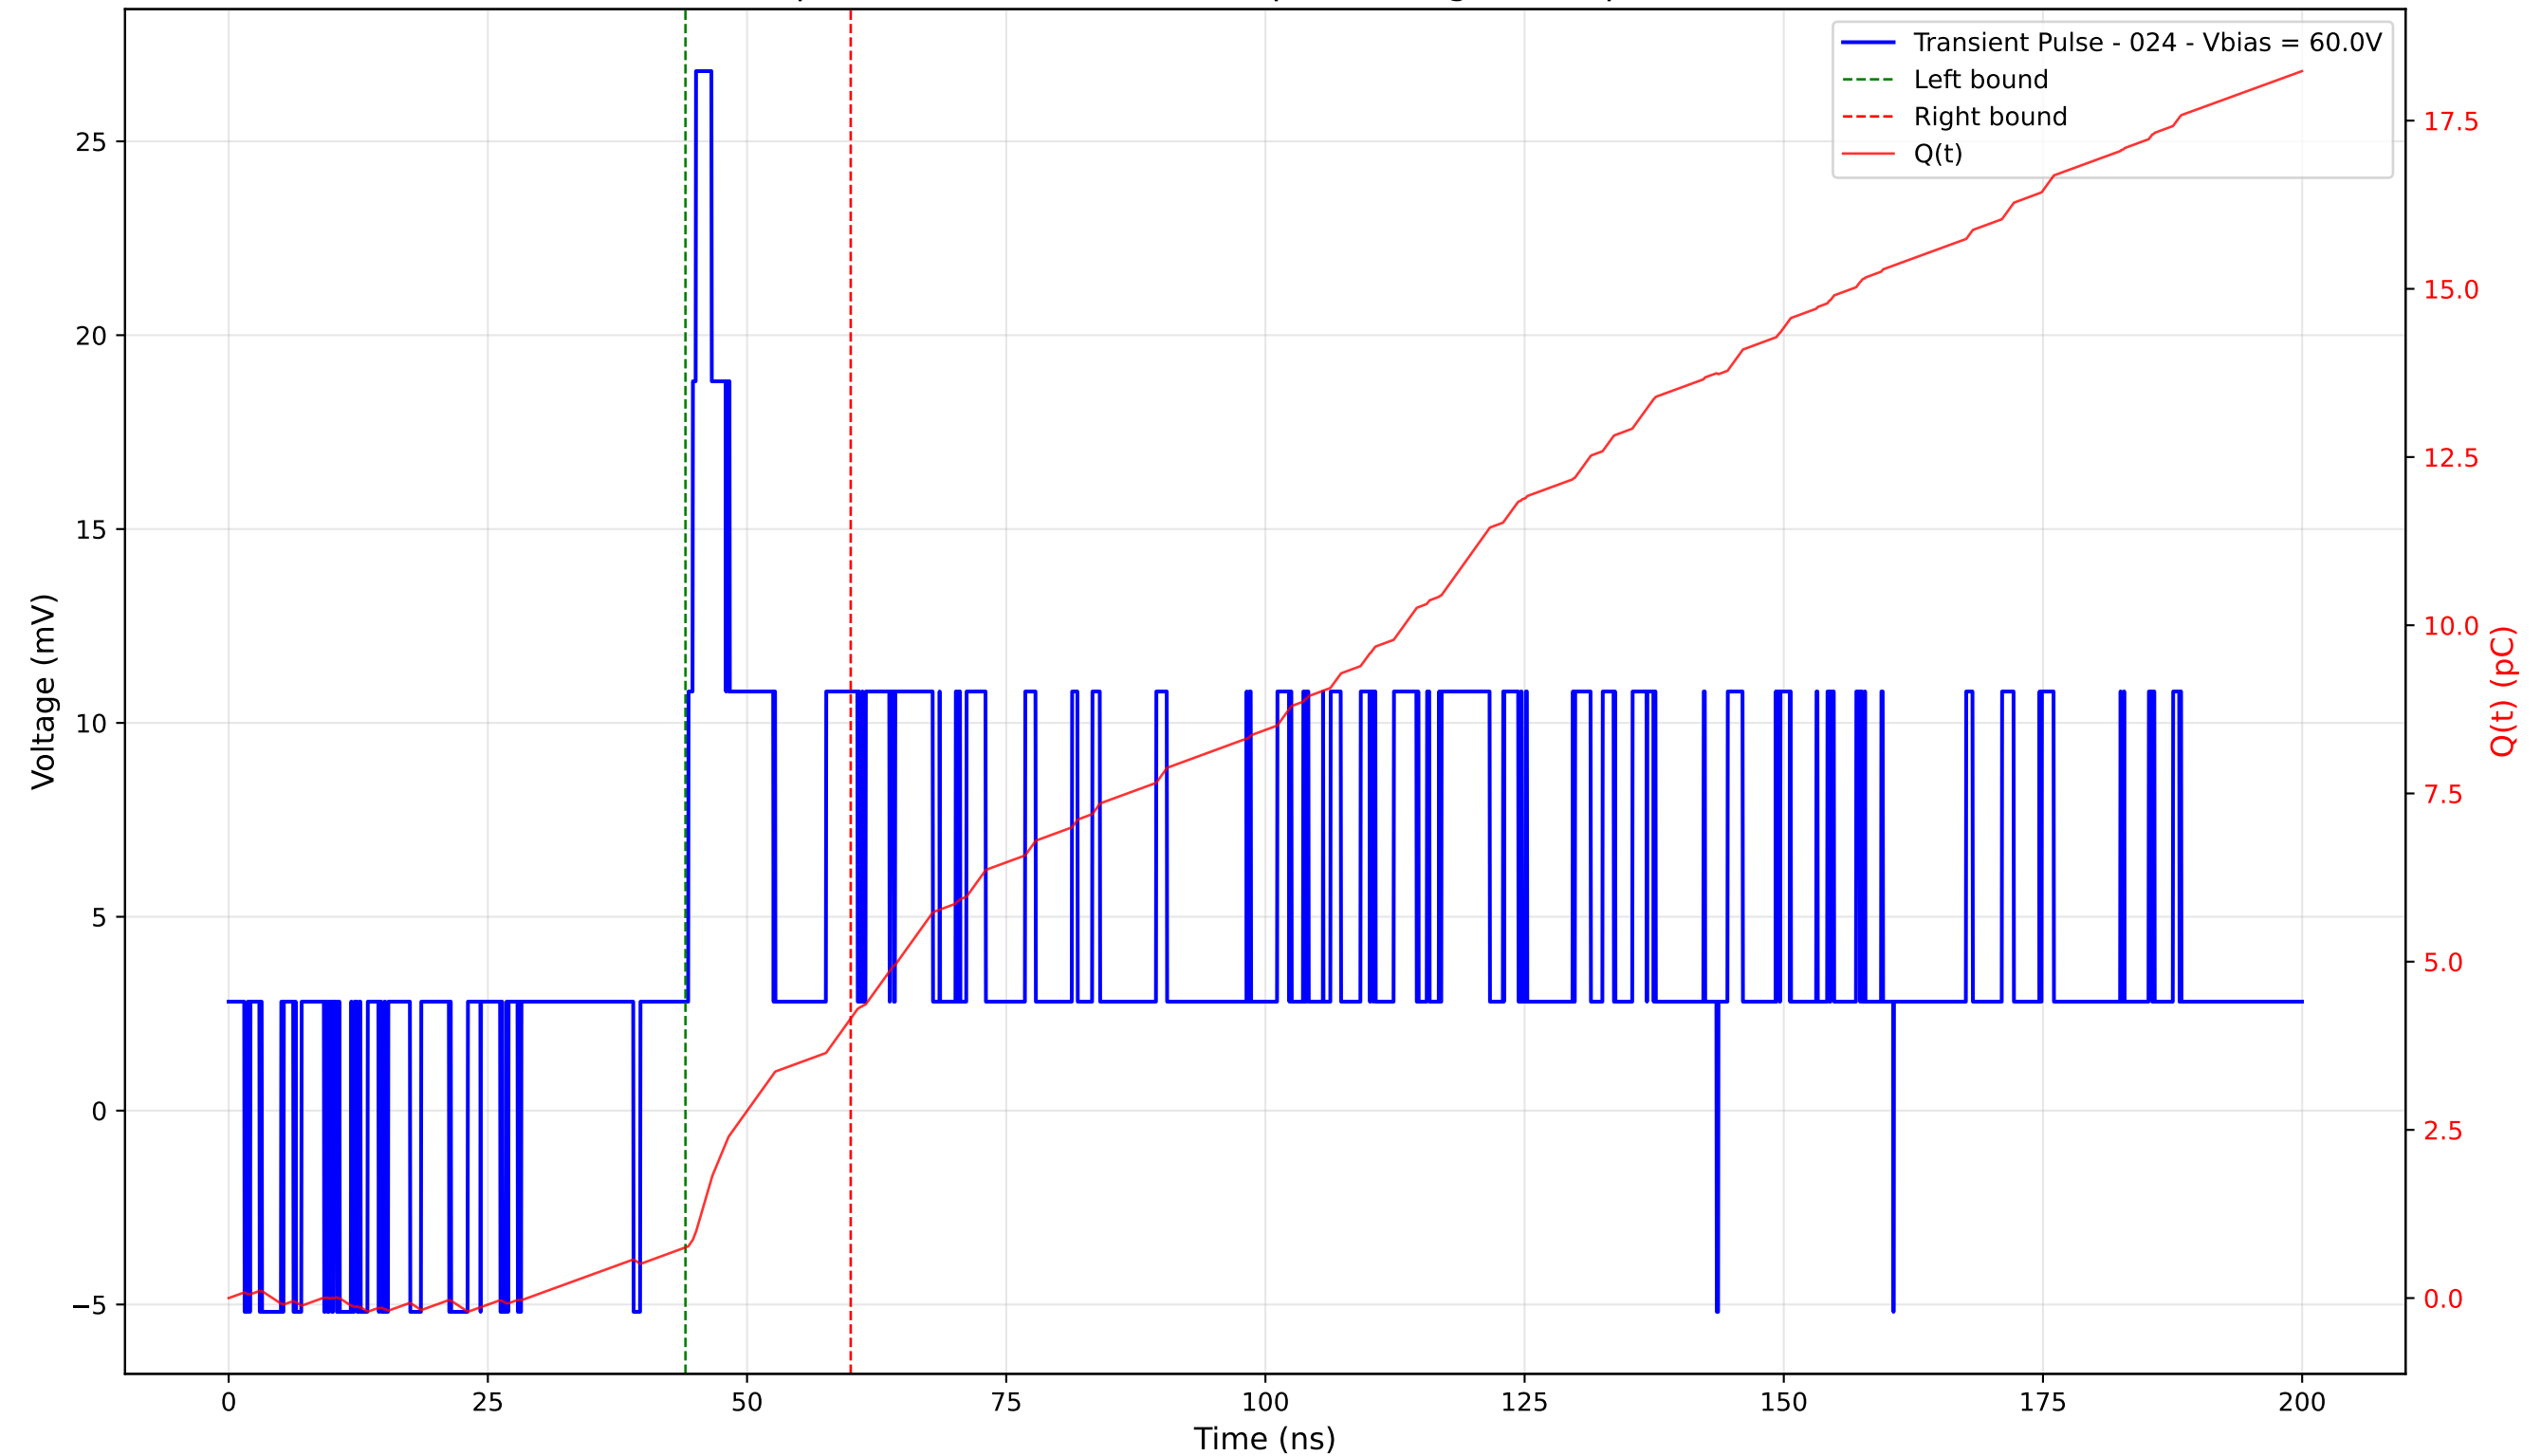


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 3.37 pC - Rise Time: 0.00 ns (N/A)

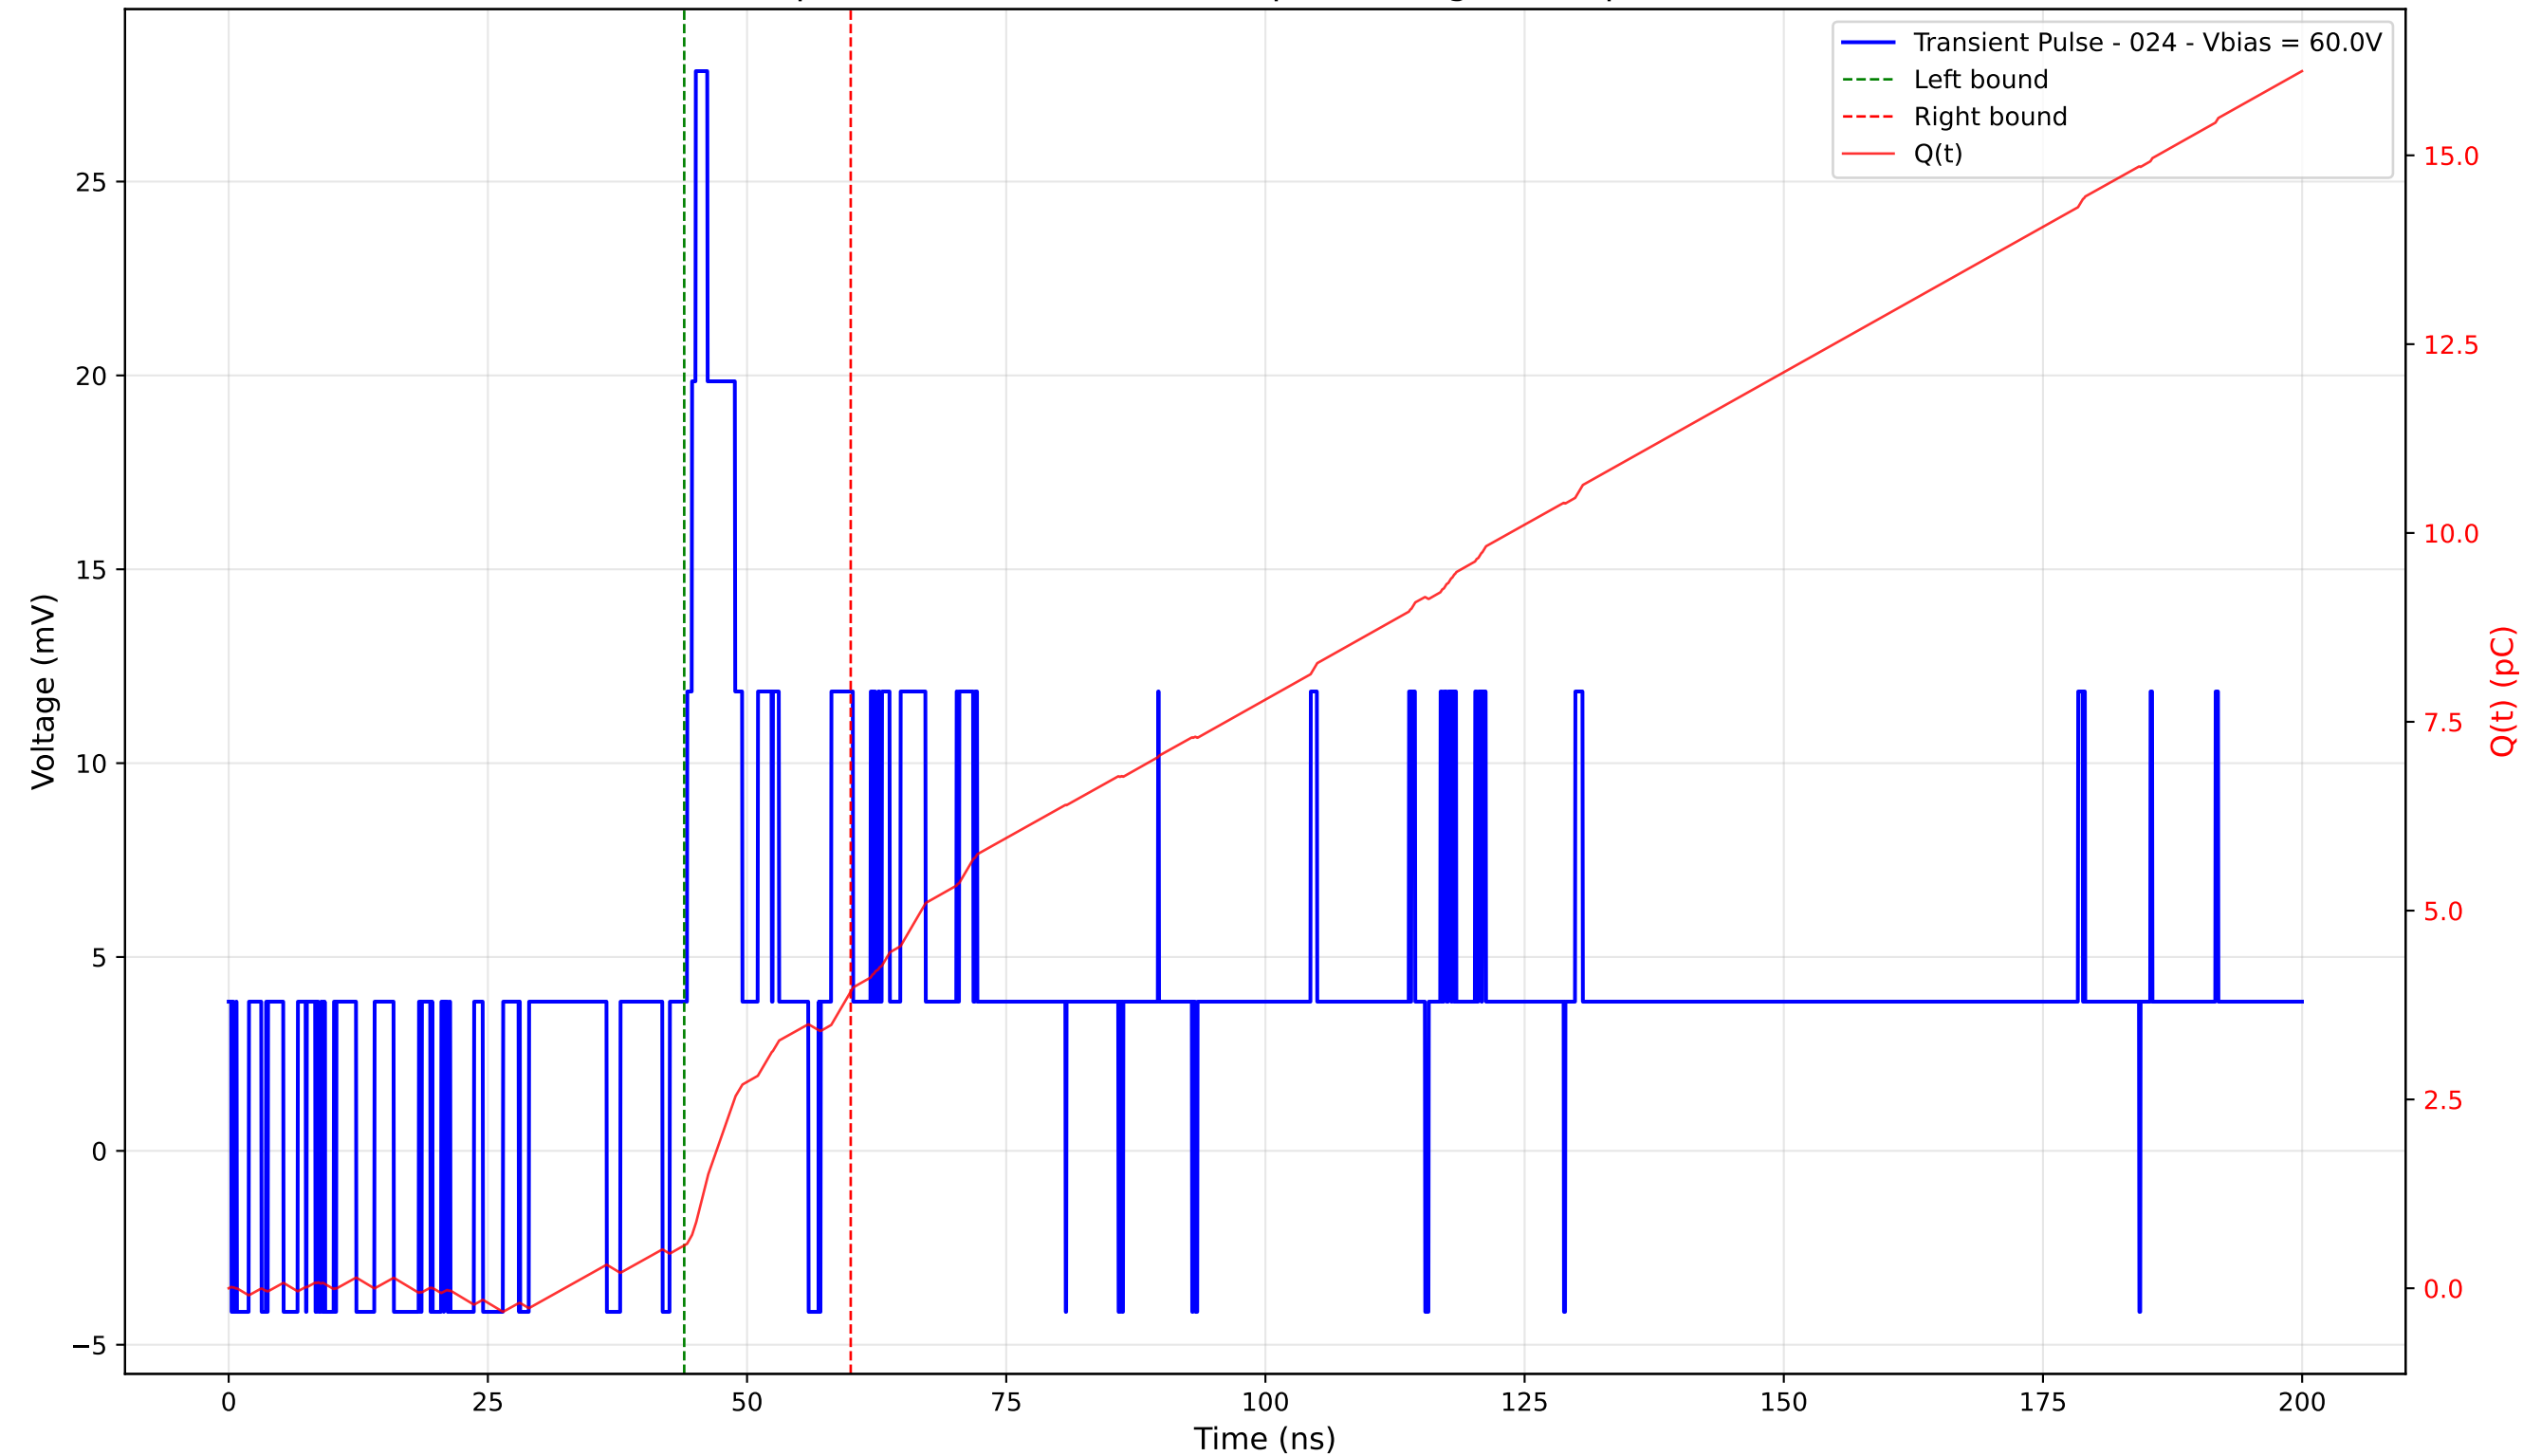


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 2.97 pC - Rise Time: 1.26 ns

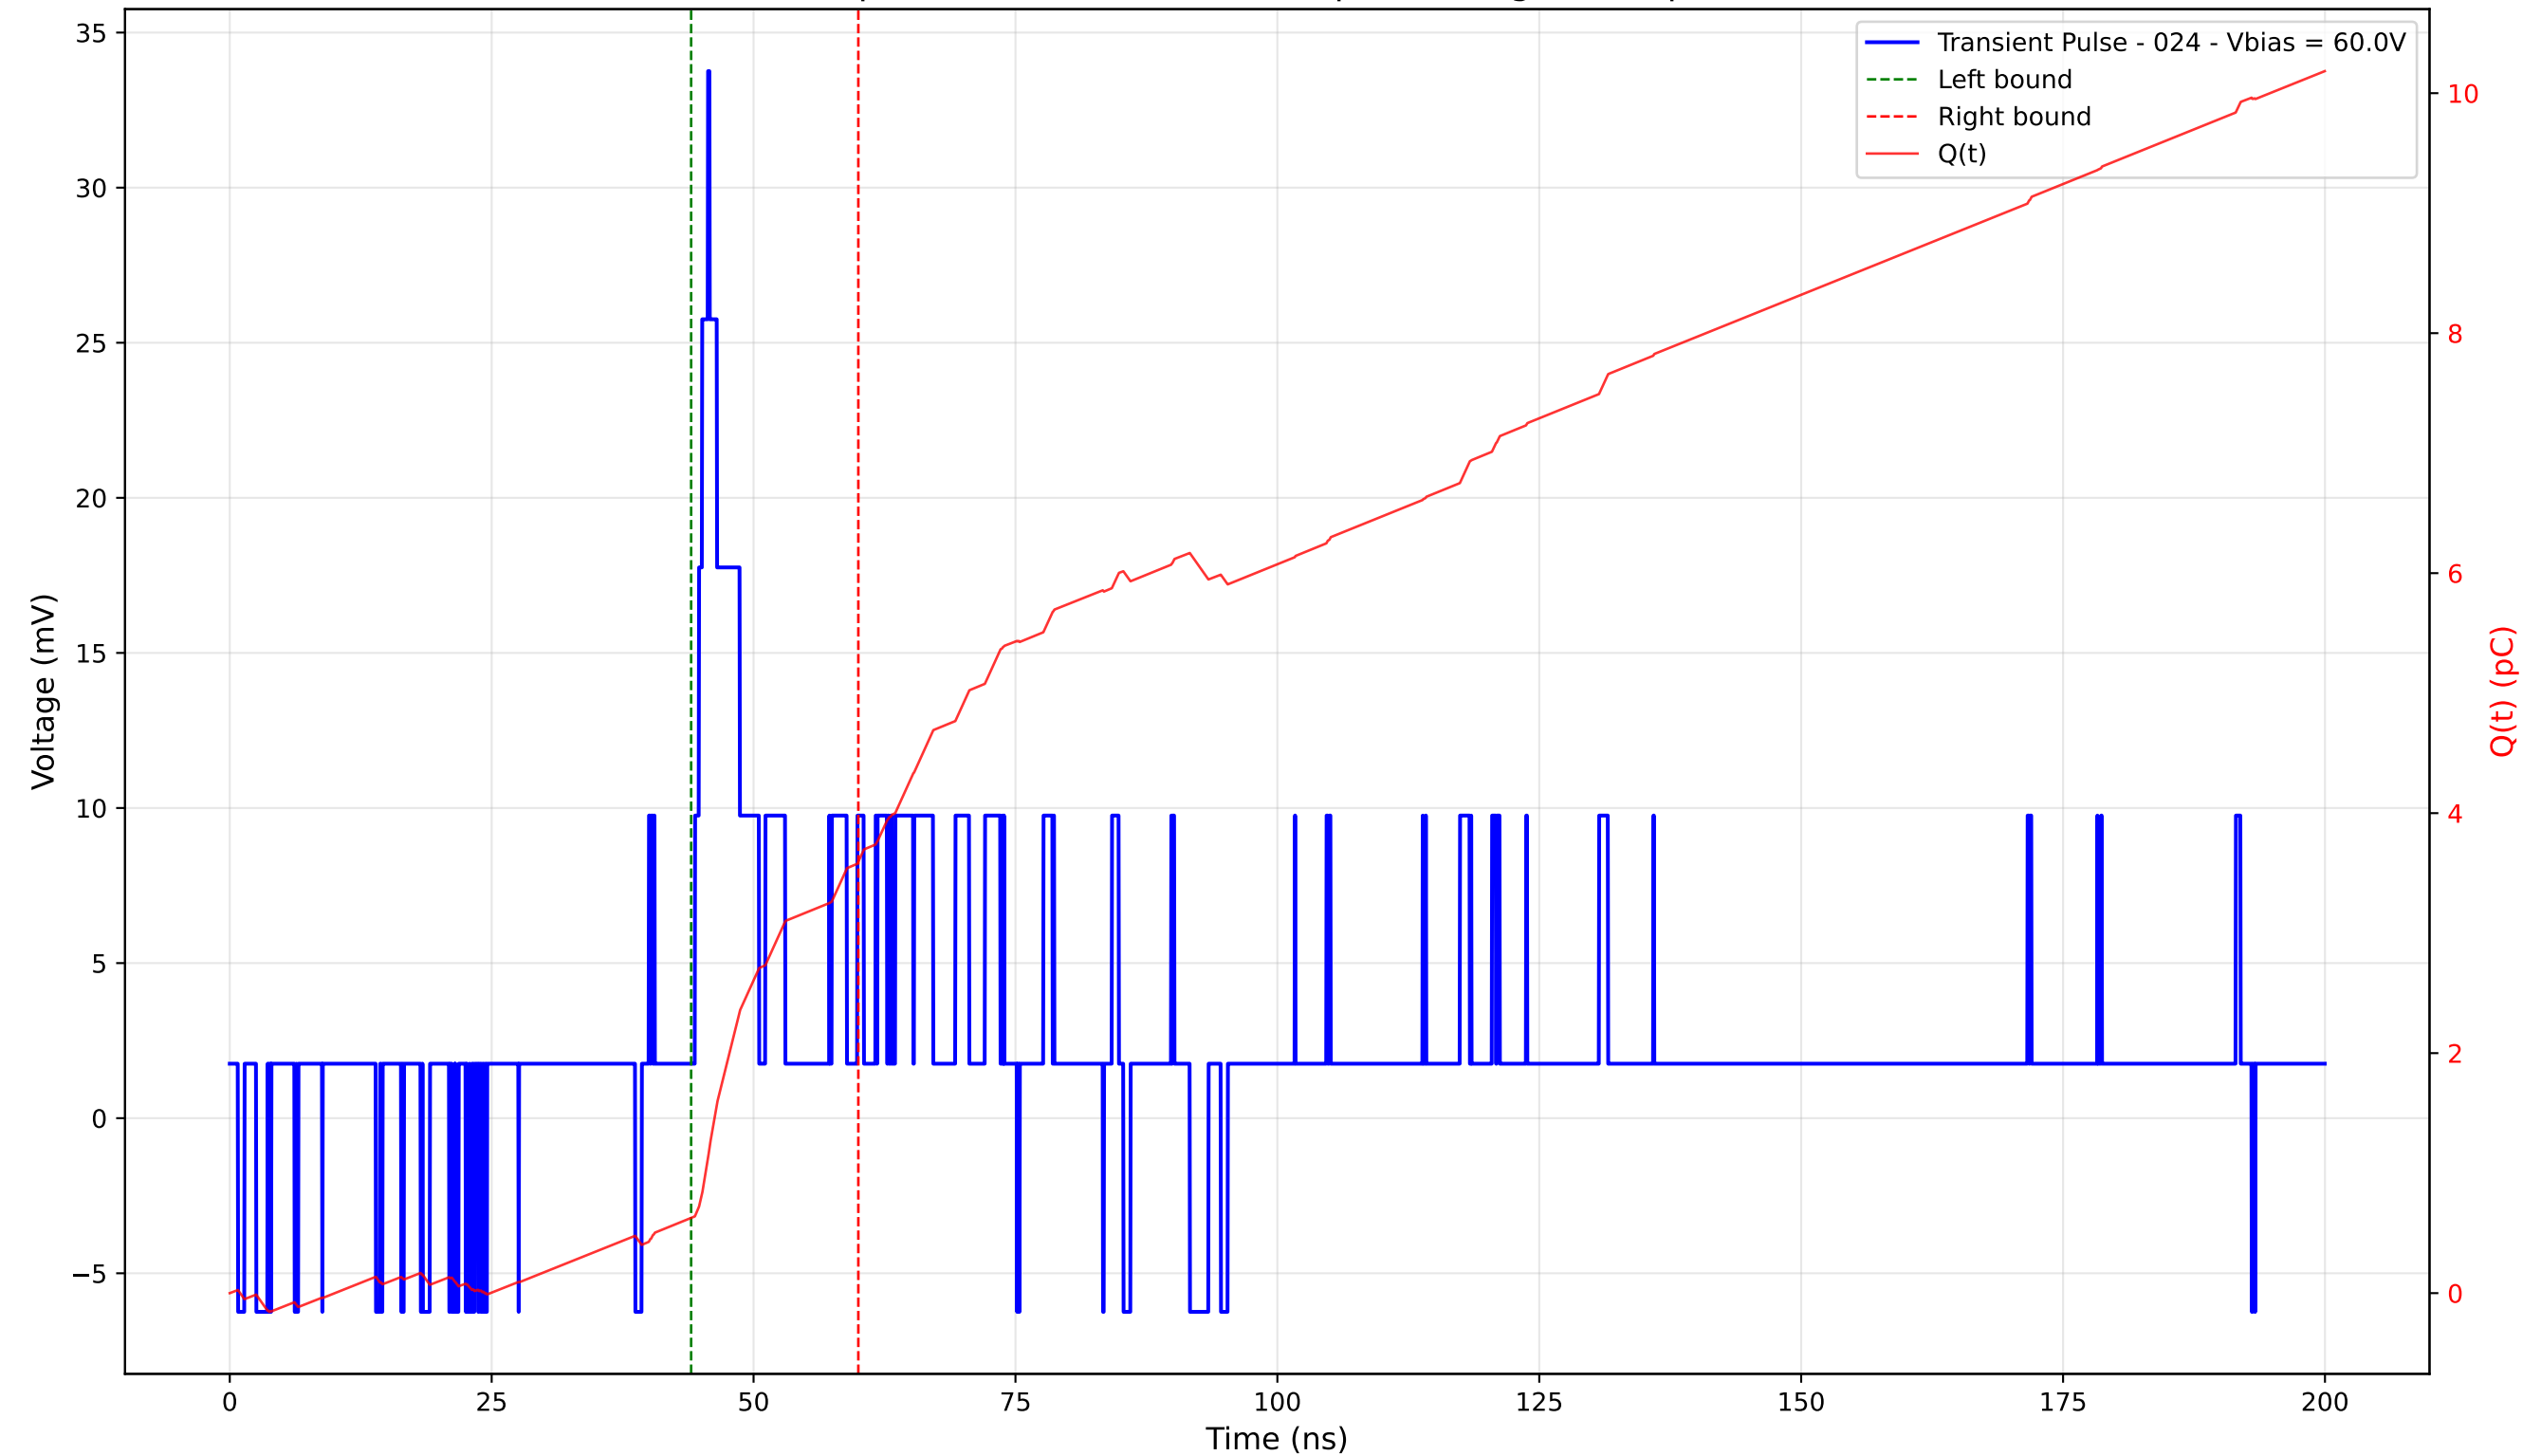


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 2.82 pC - Rise Time: 0.81 ns

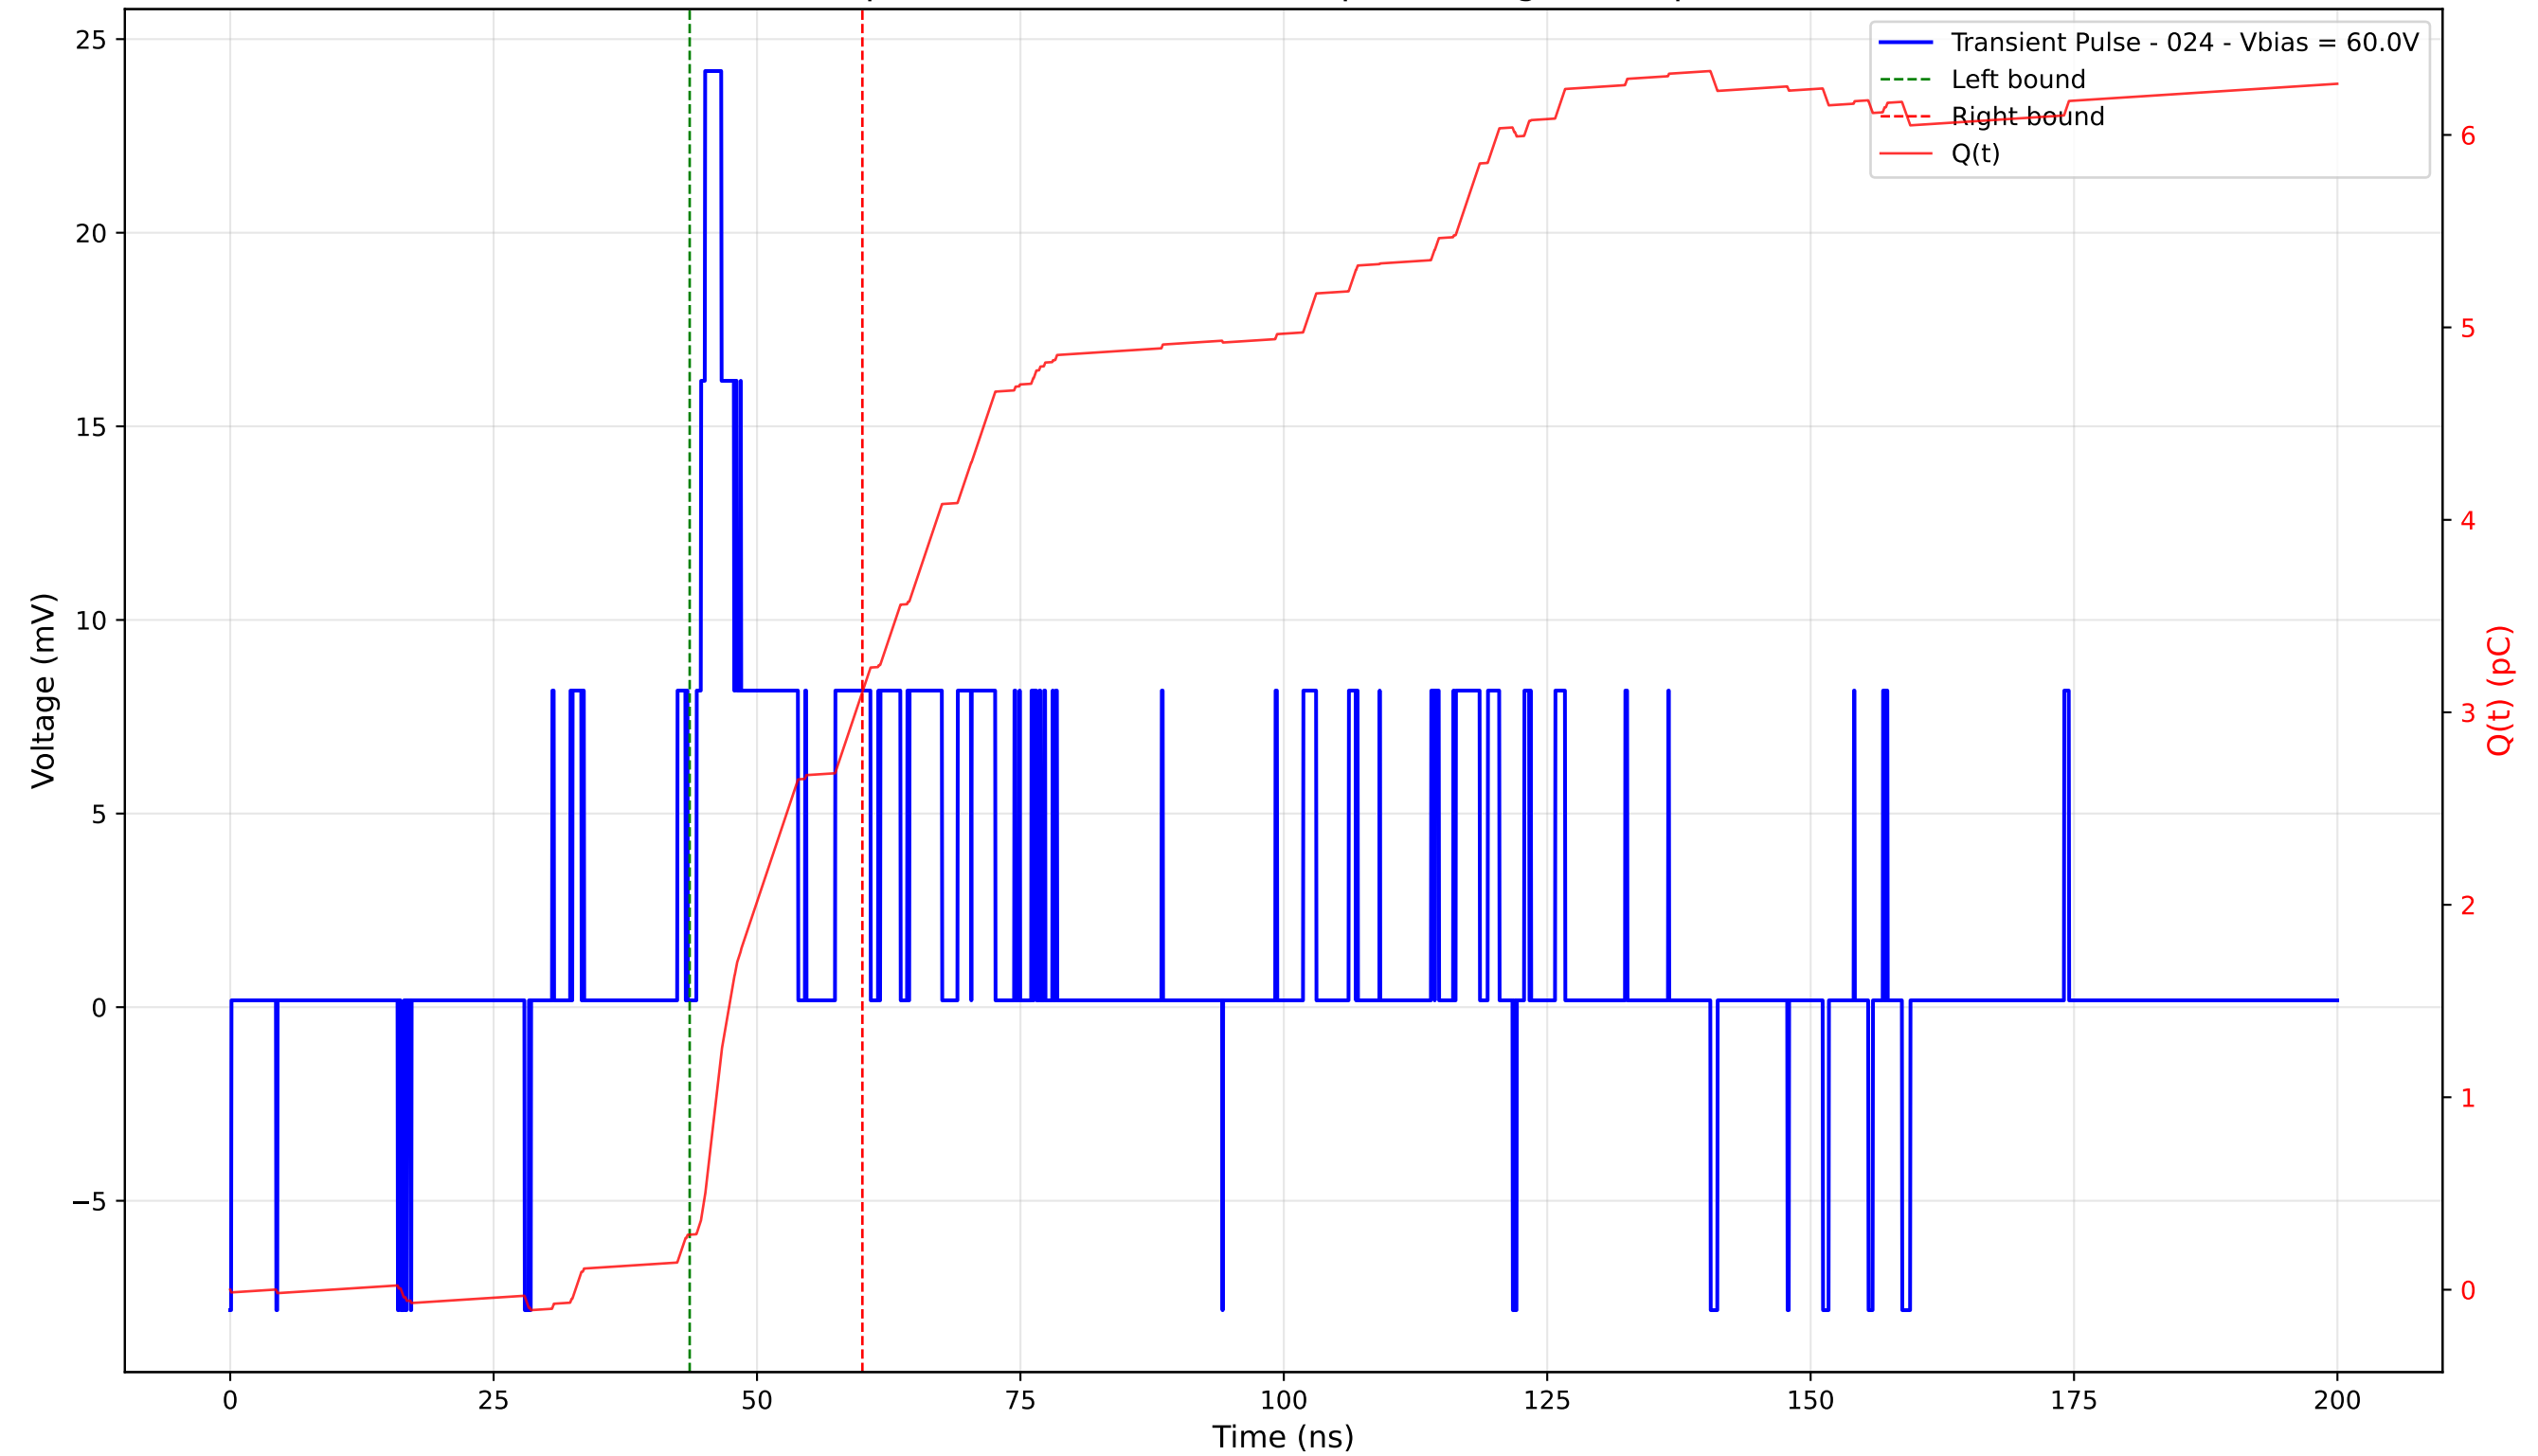


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 3.25 pC - Rise Time: 1.10 ns

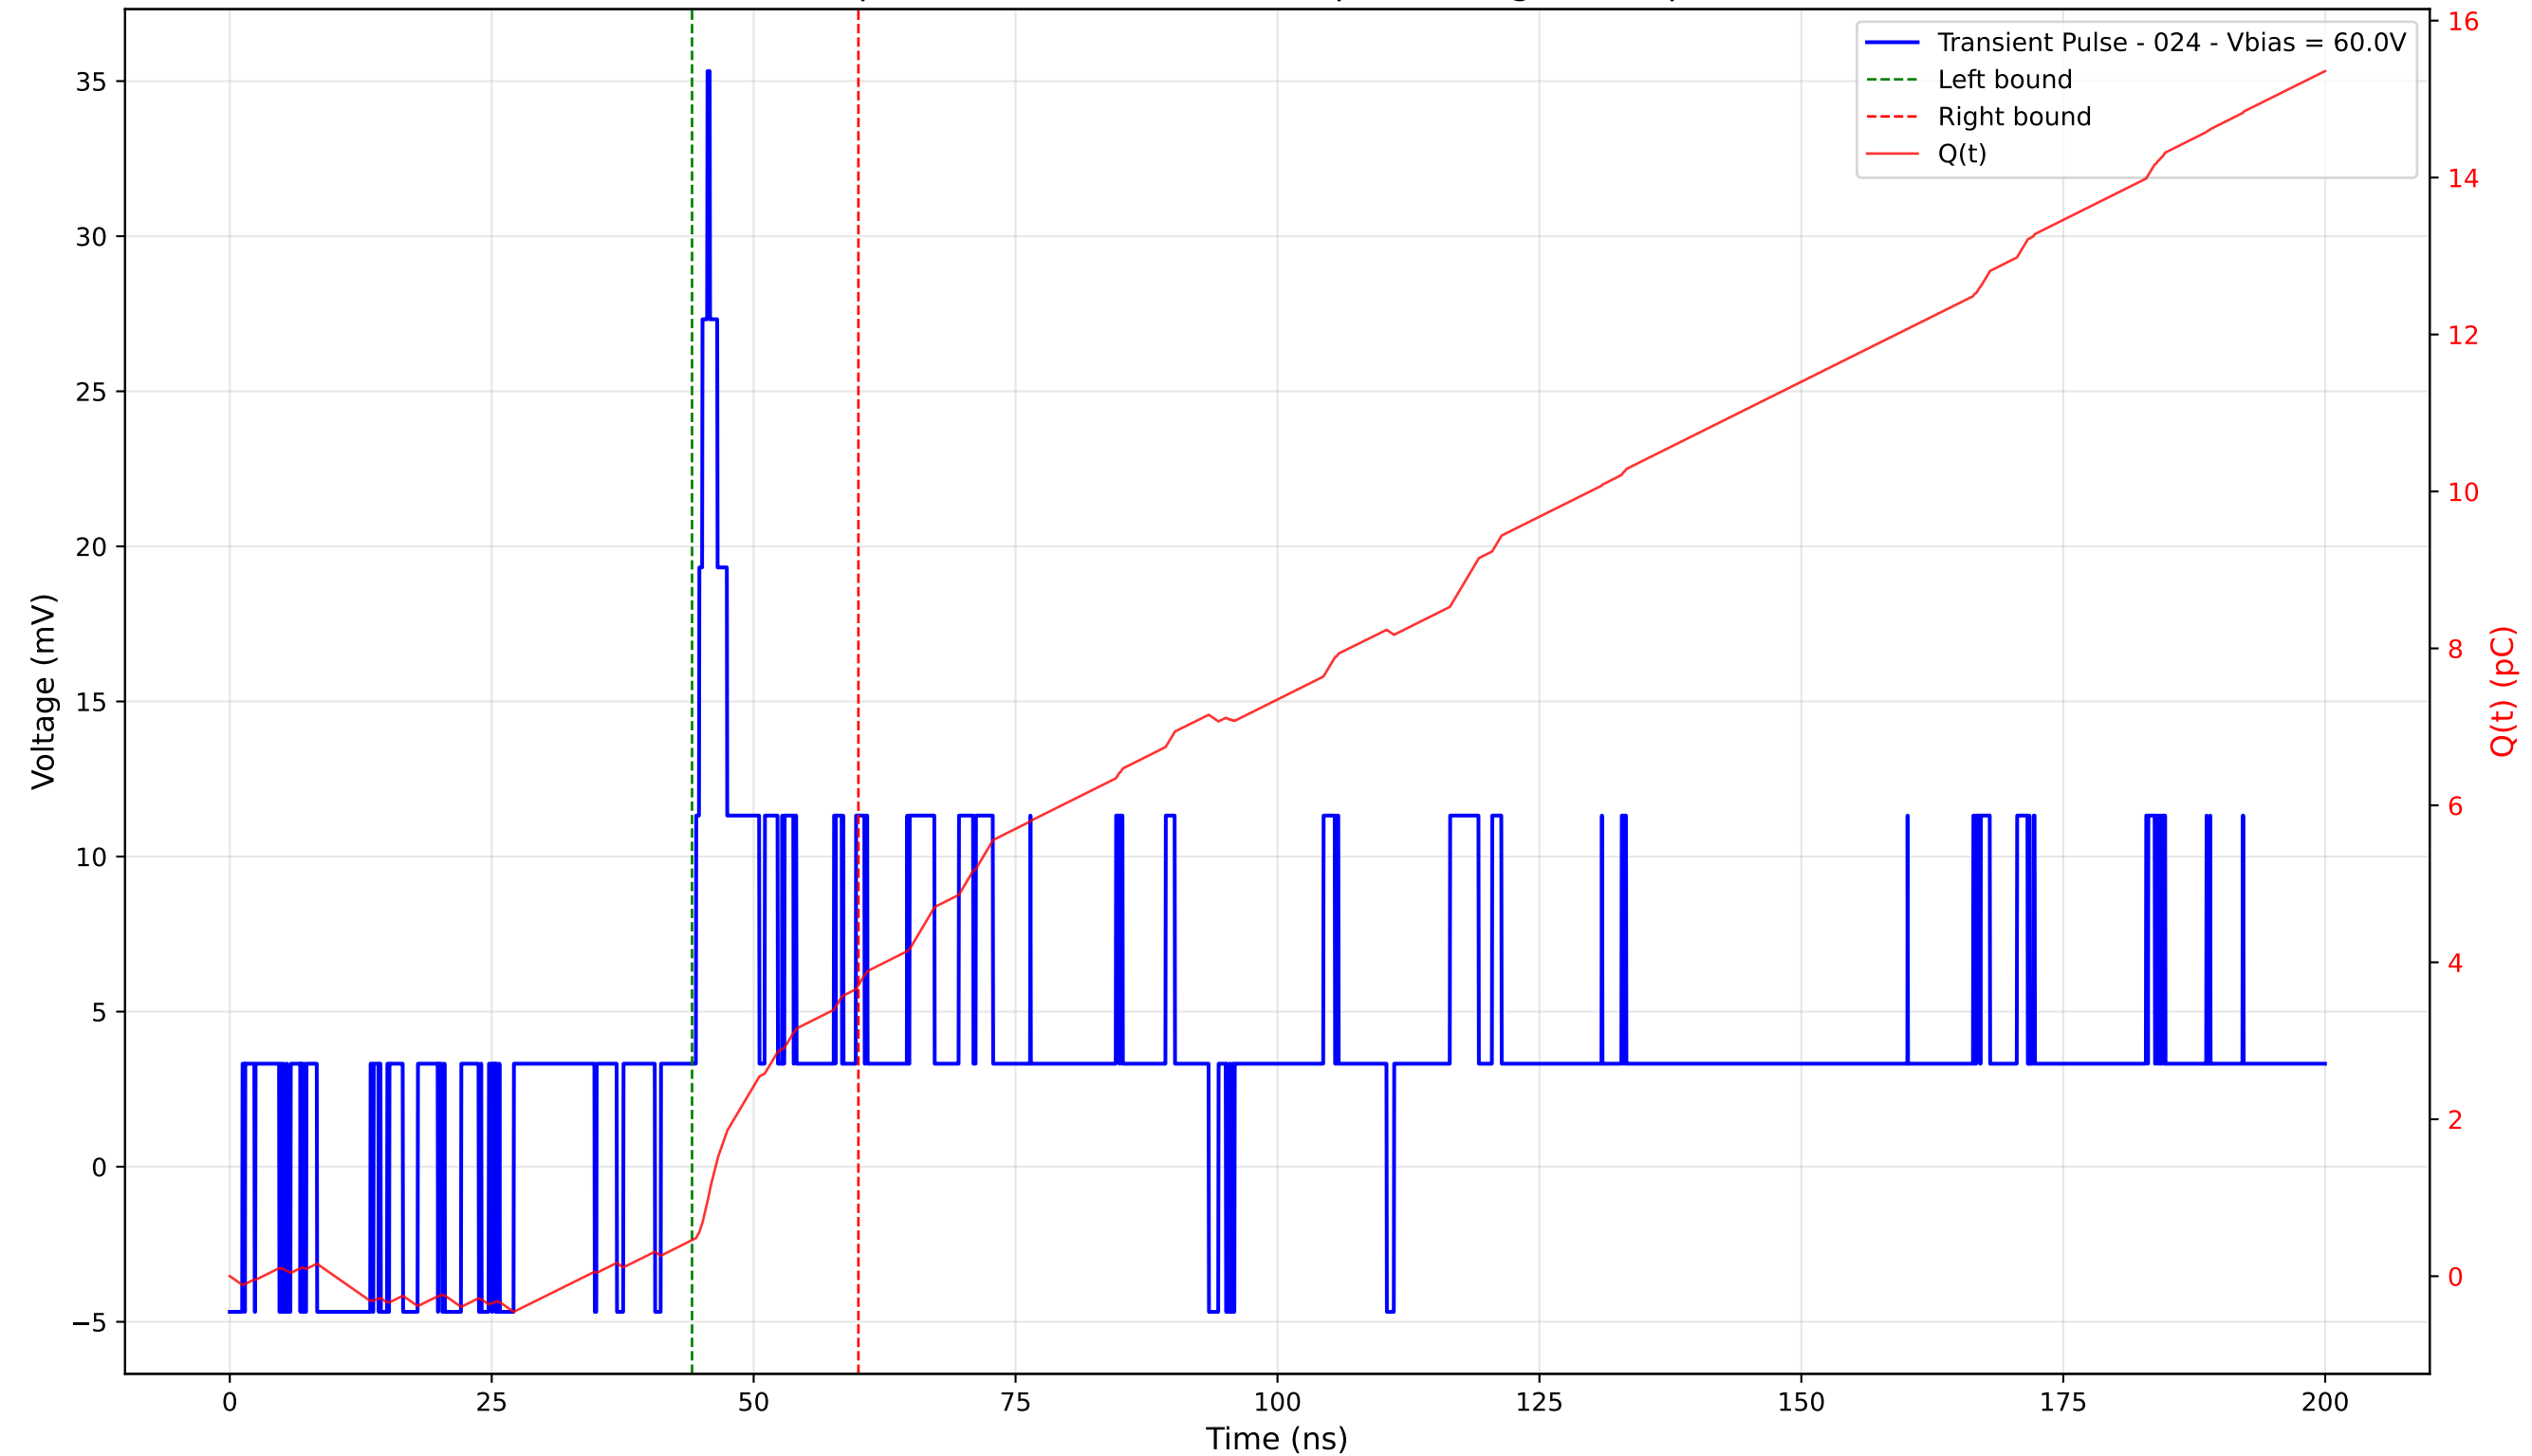


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 2.85 pC - Rise Time: 0.90 ns

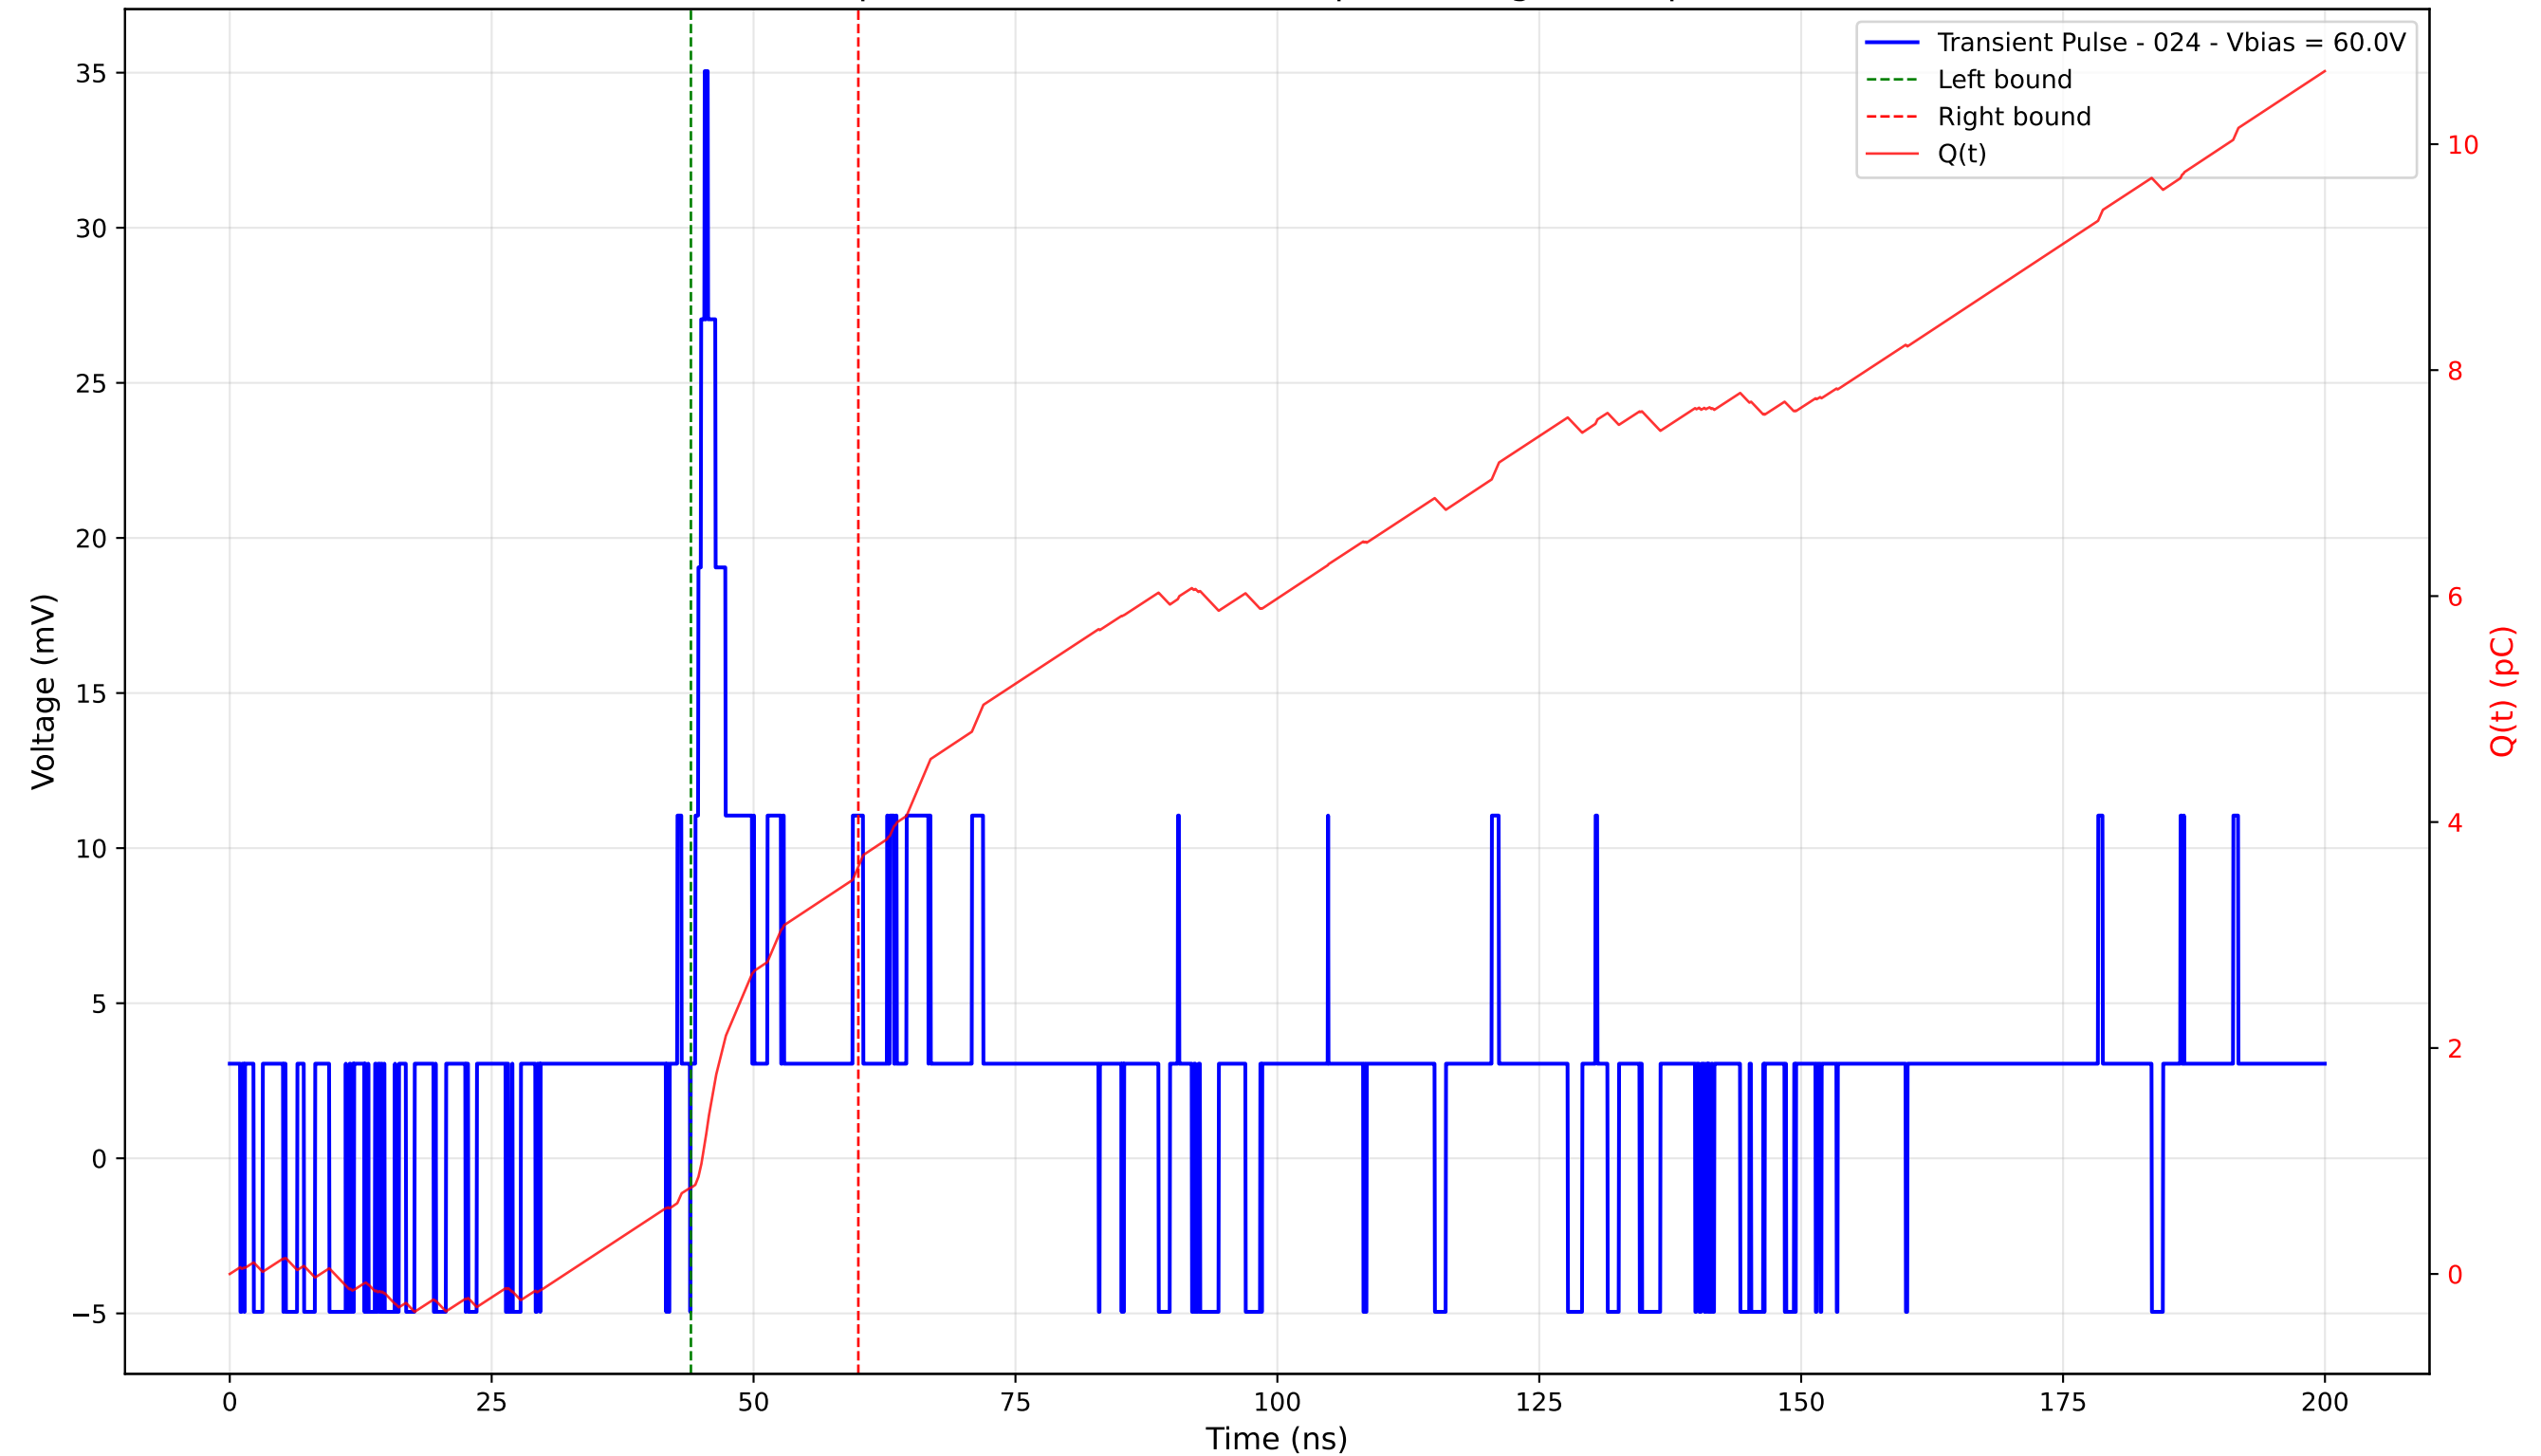


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 2.72 pC - Rise Time: 1.09 ns

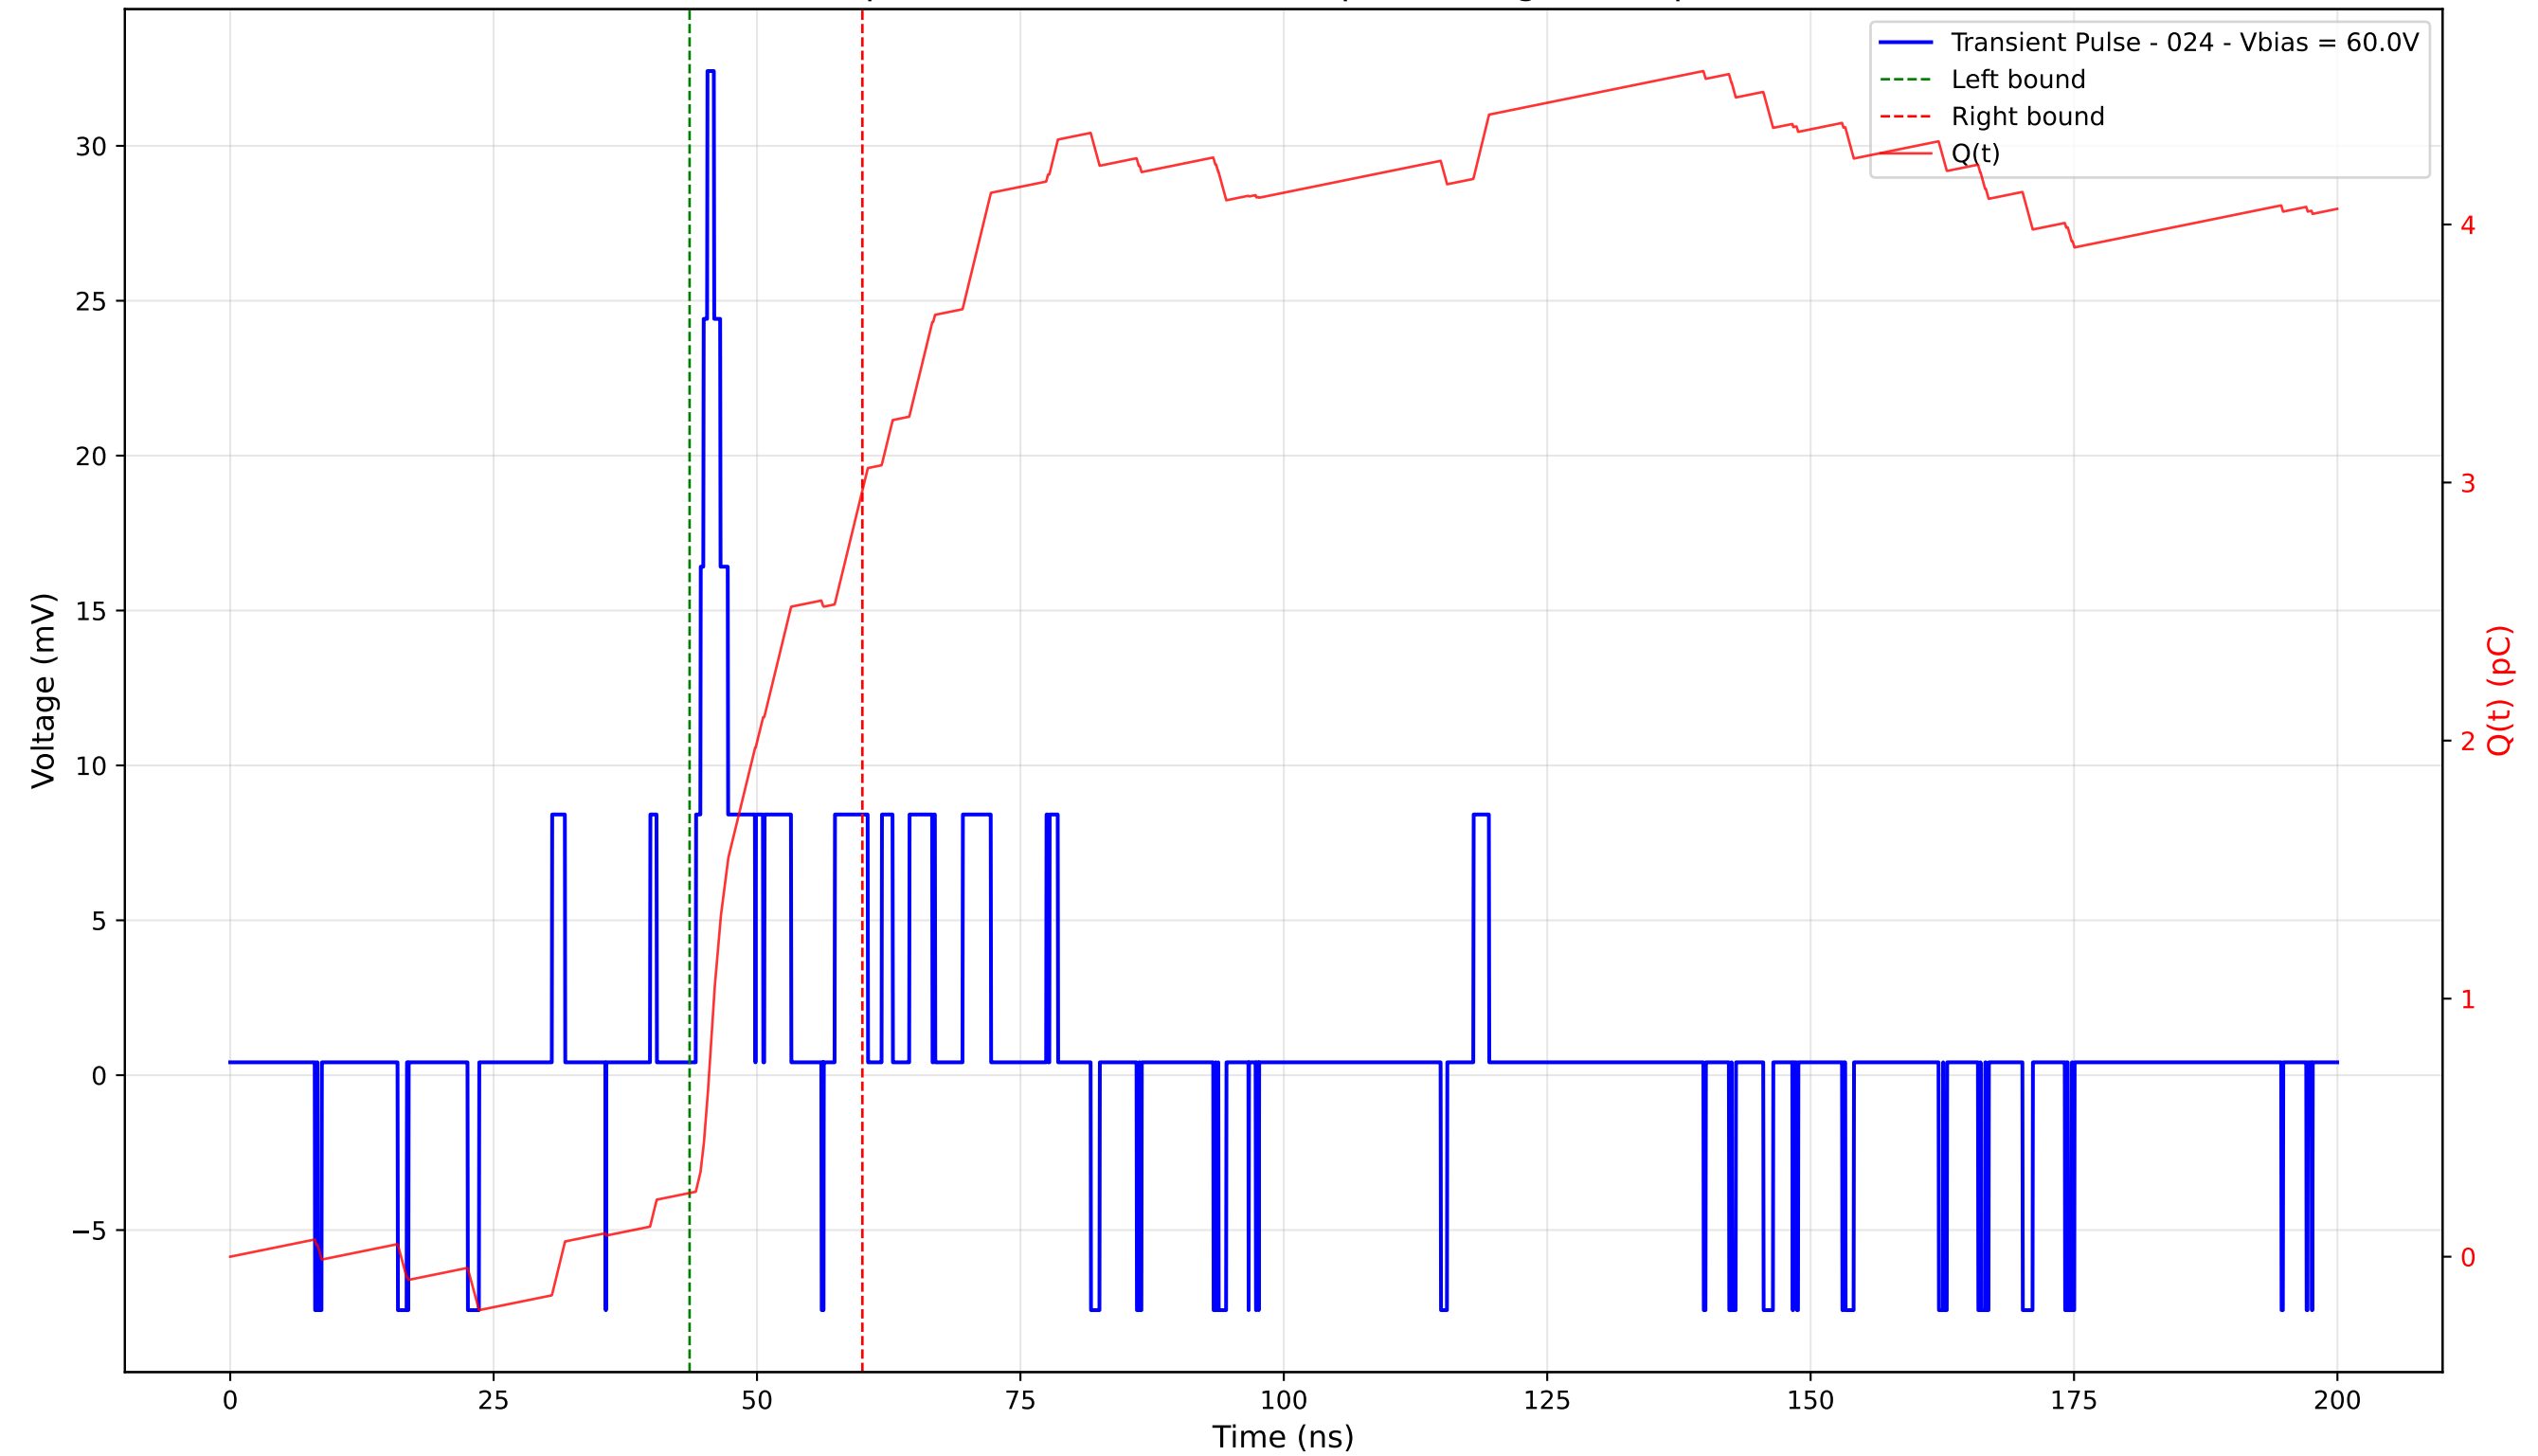


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 3.16 pC - Rise Time: 1.16 ns

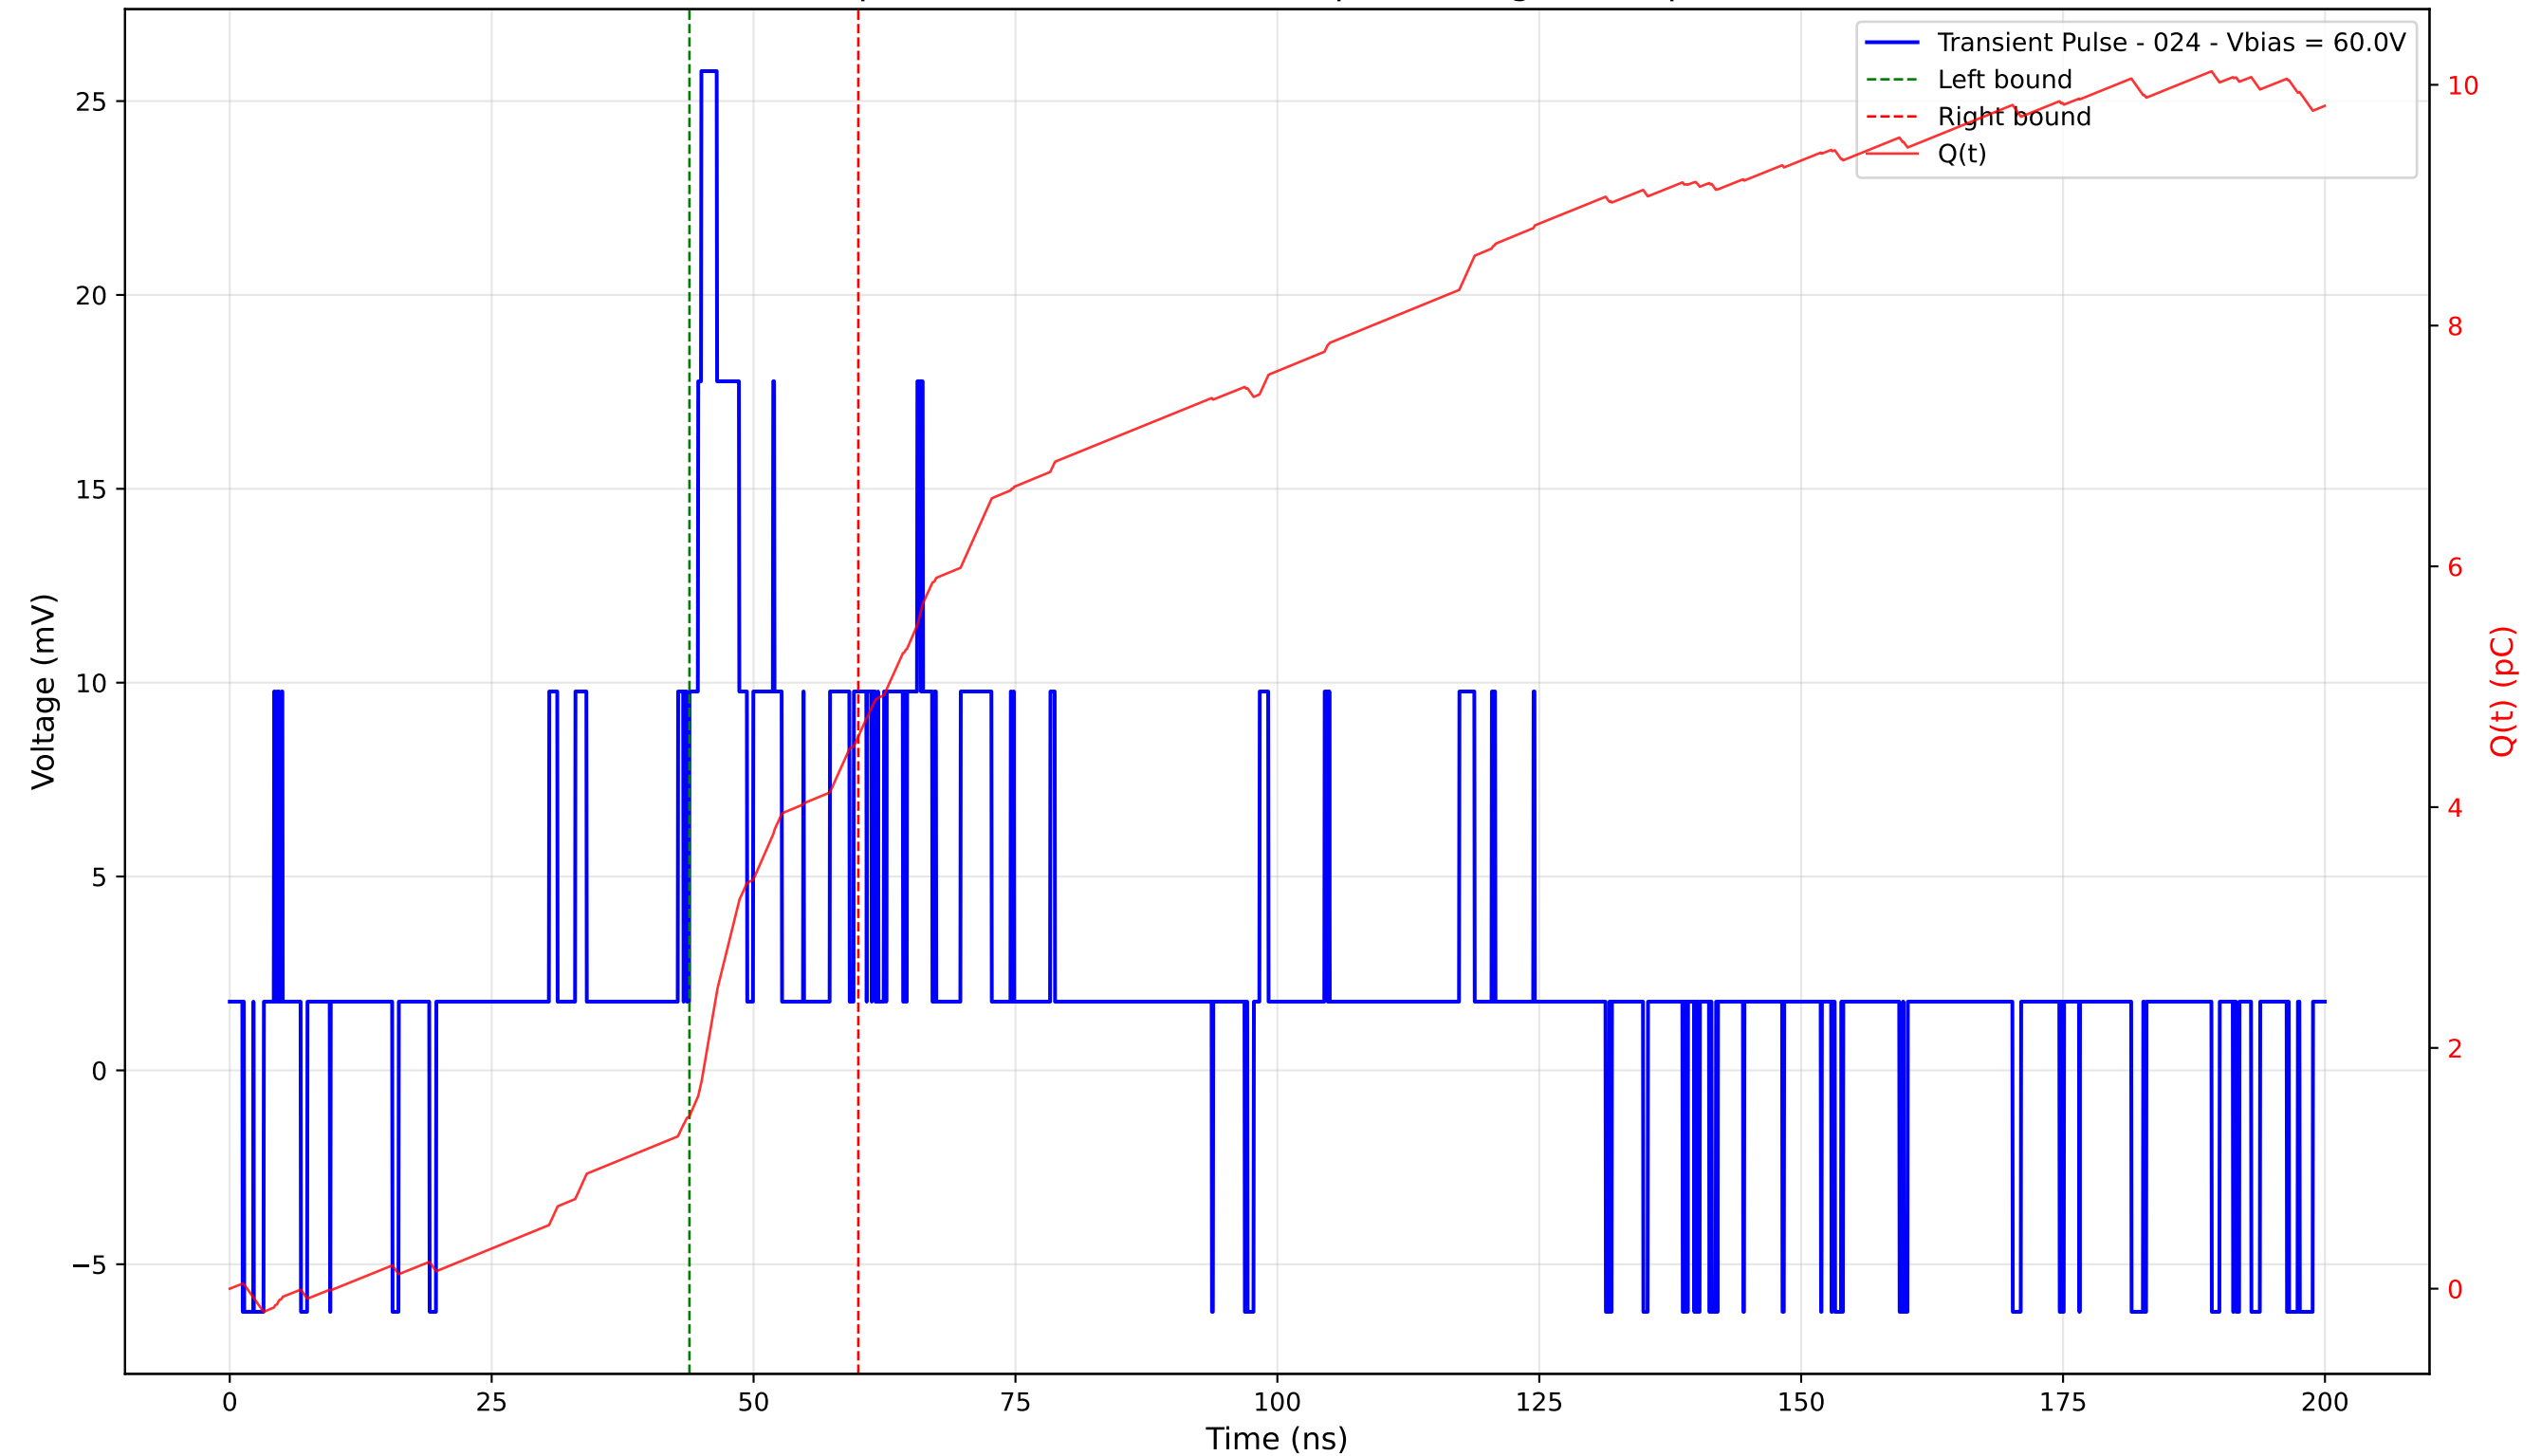


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 2.98 pC - Rise Time: 0.84 ns

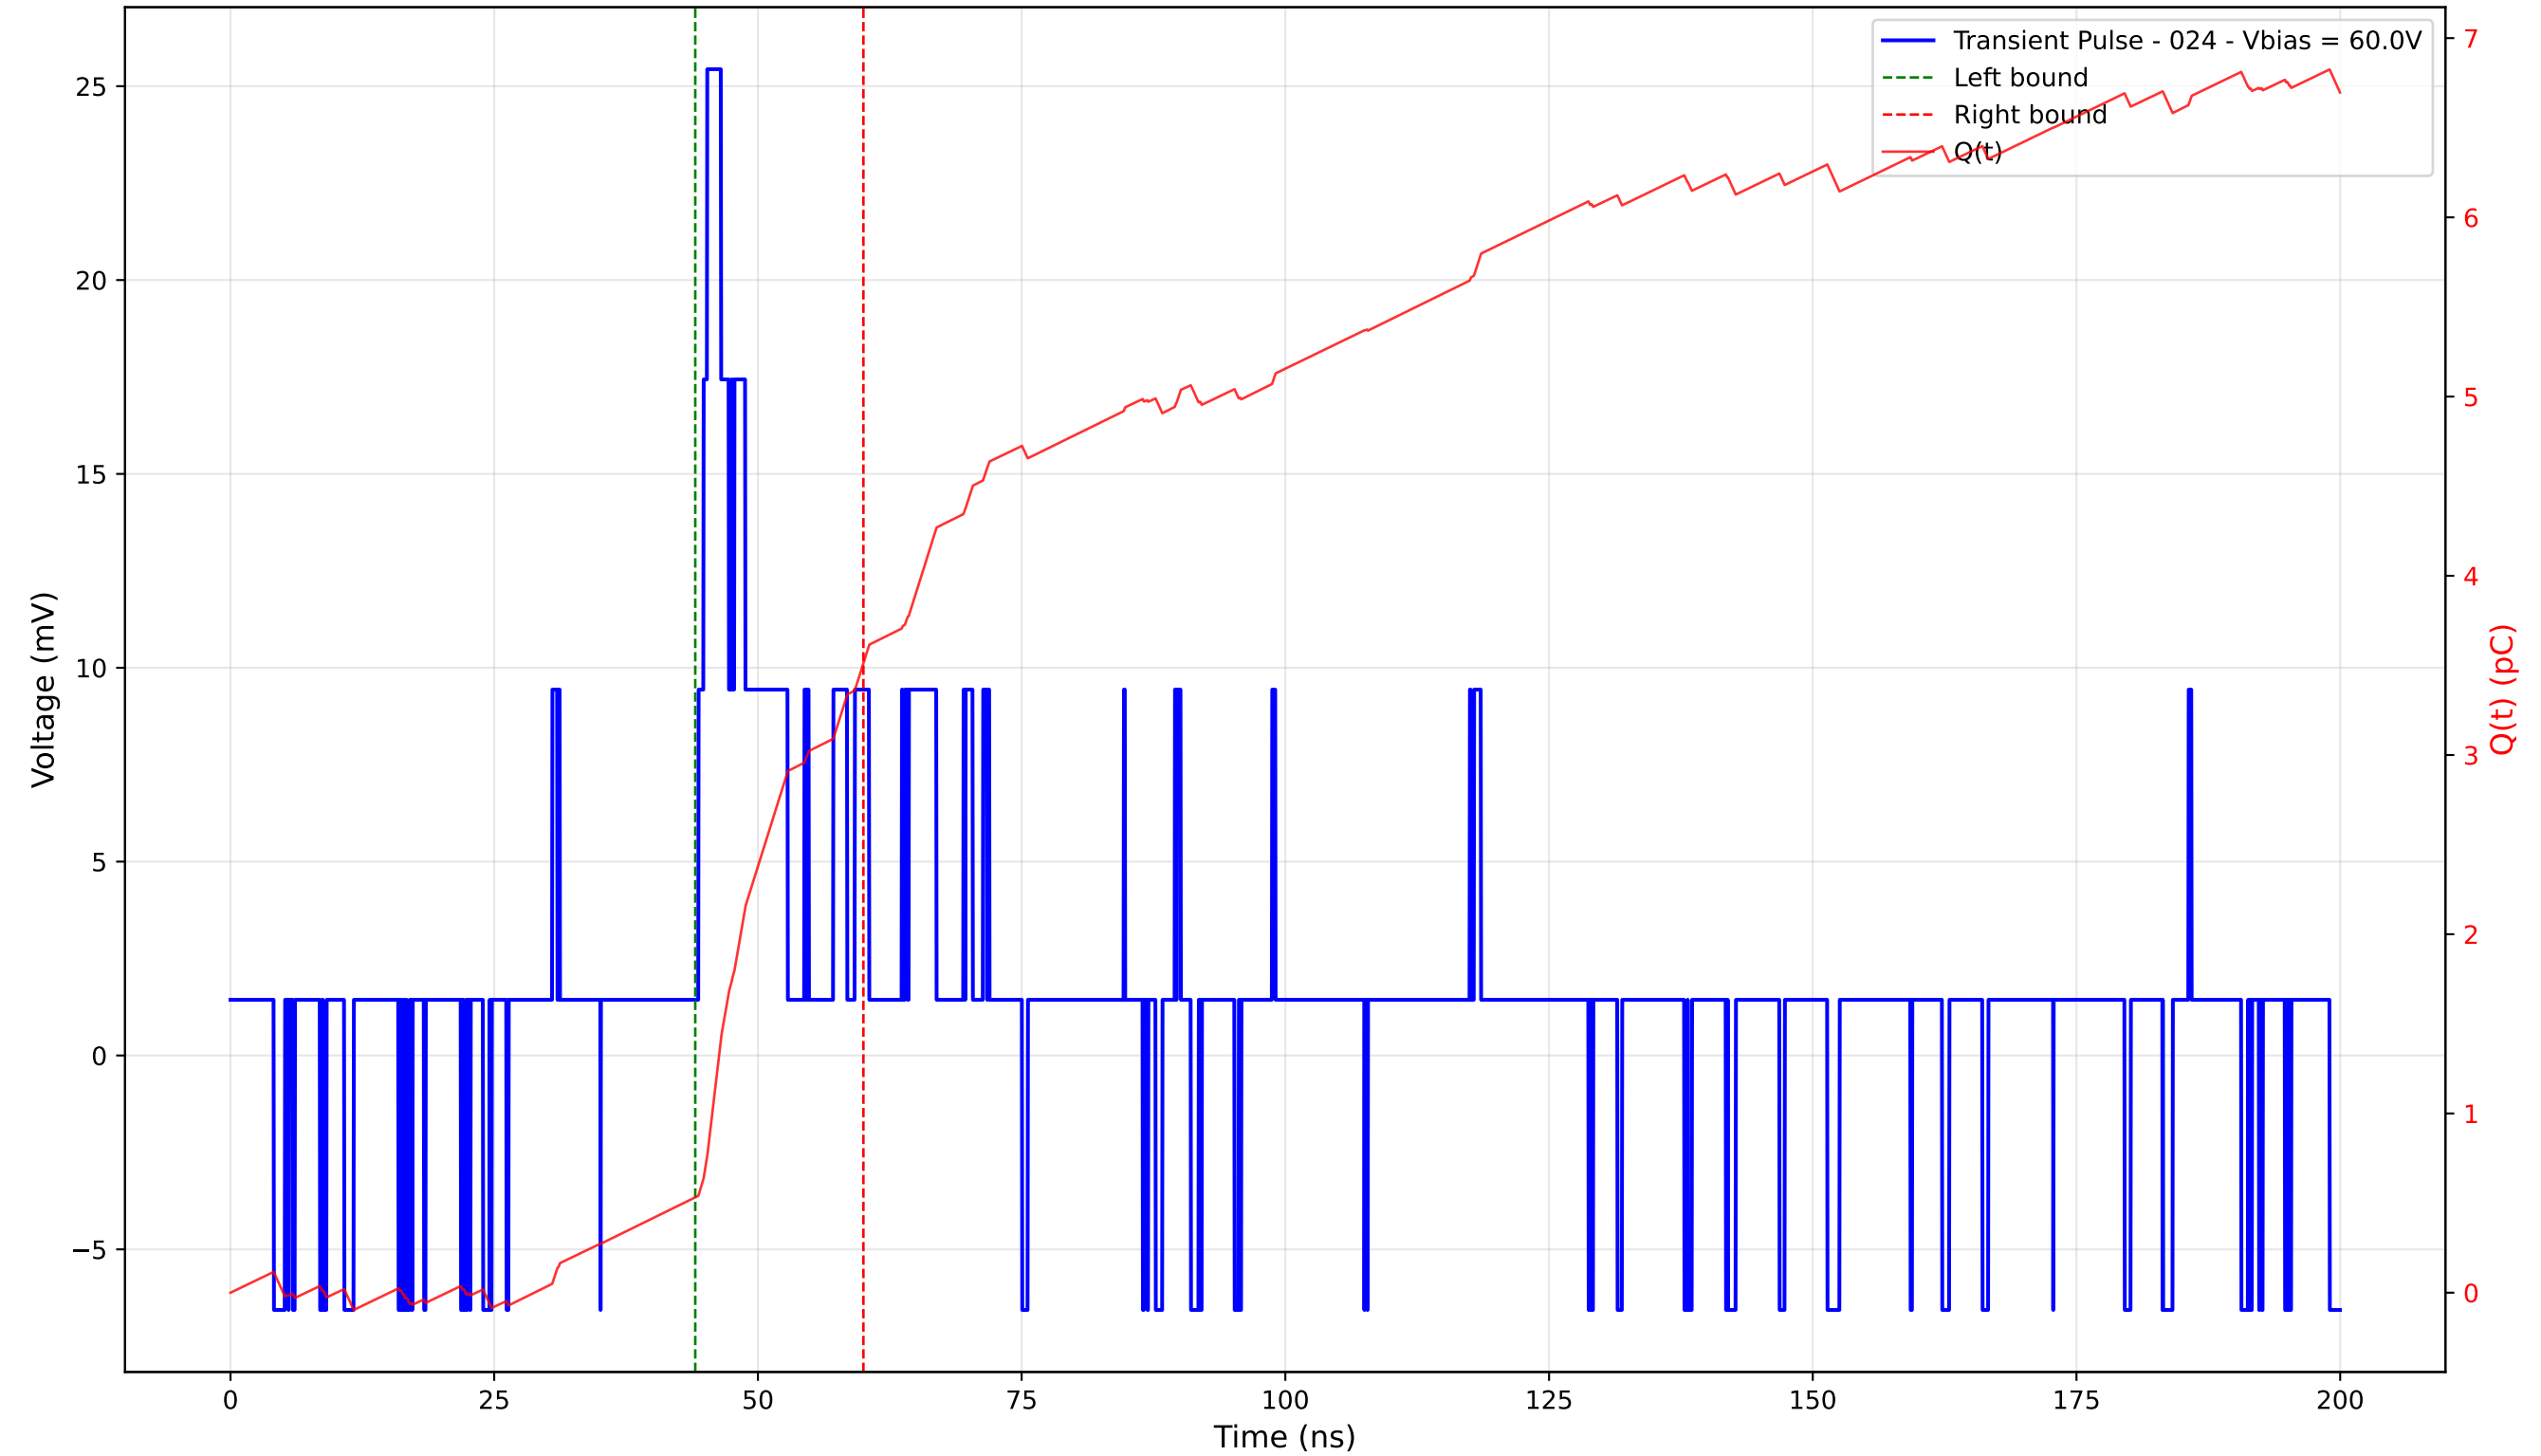


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 2.24 pC - Rise Time: 0.76 ns

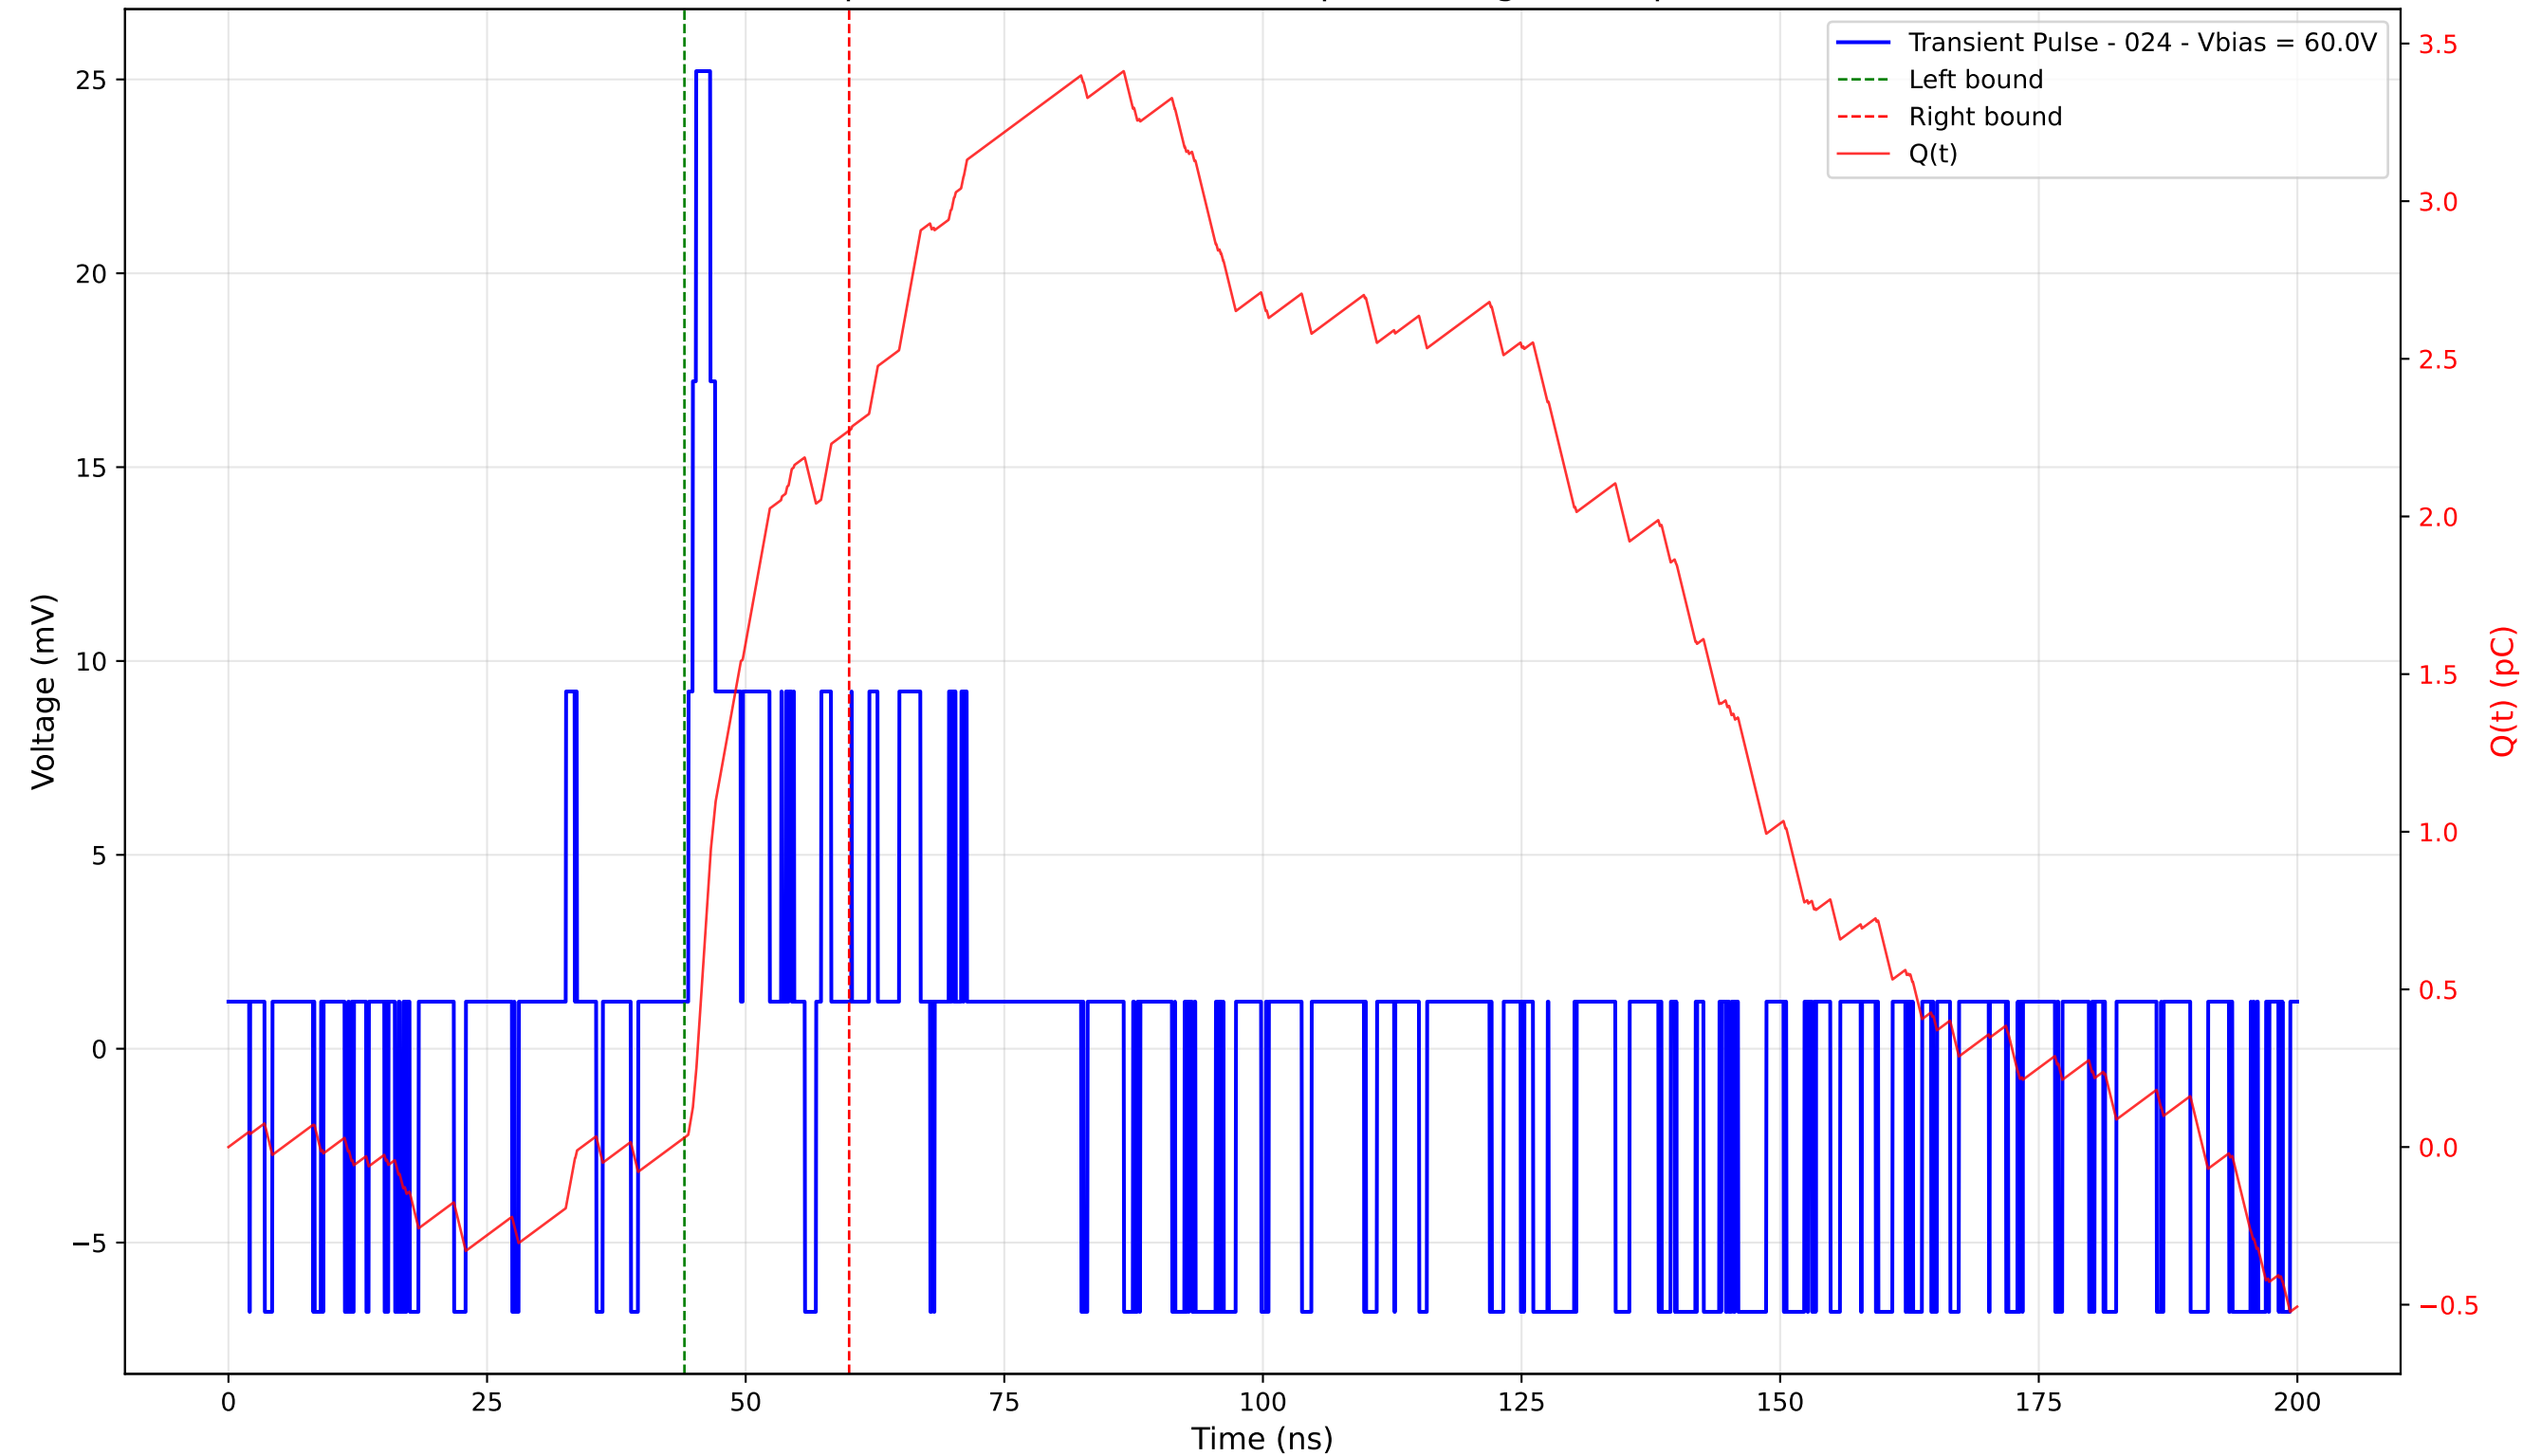


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 2.83 pC - Rise Time: 0.87 ns

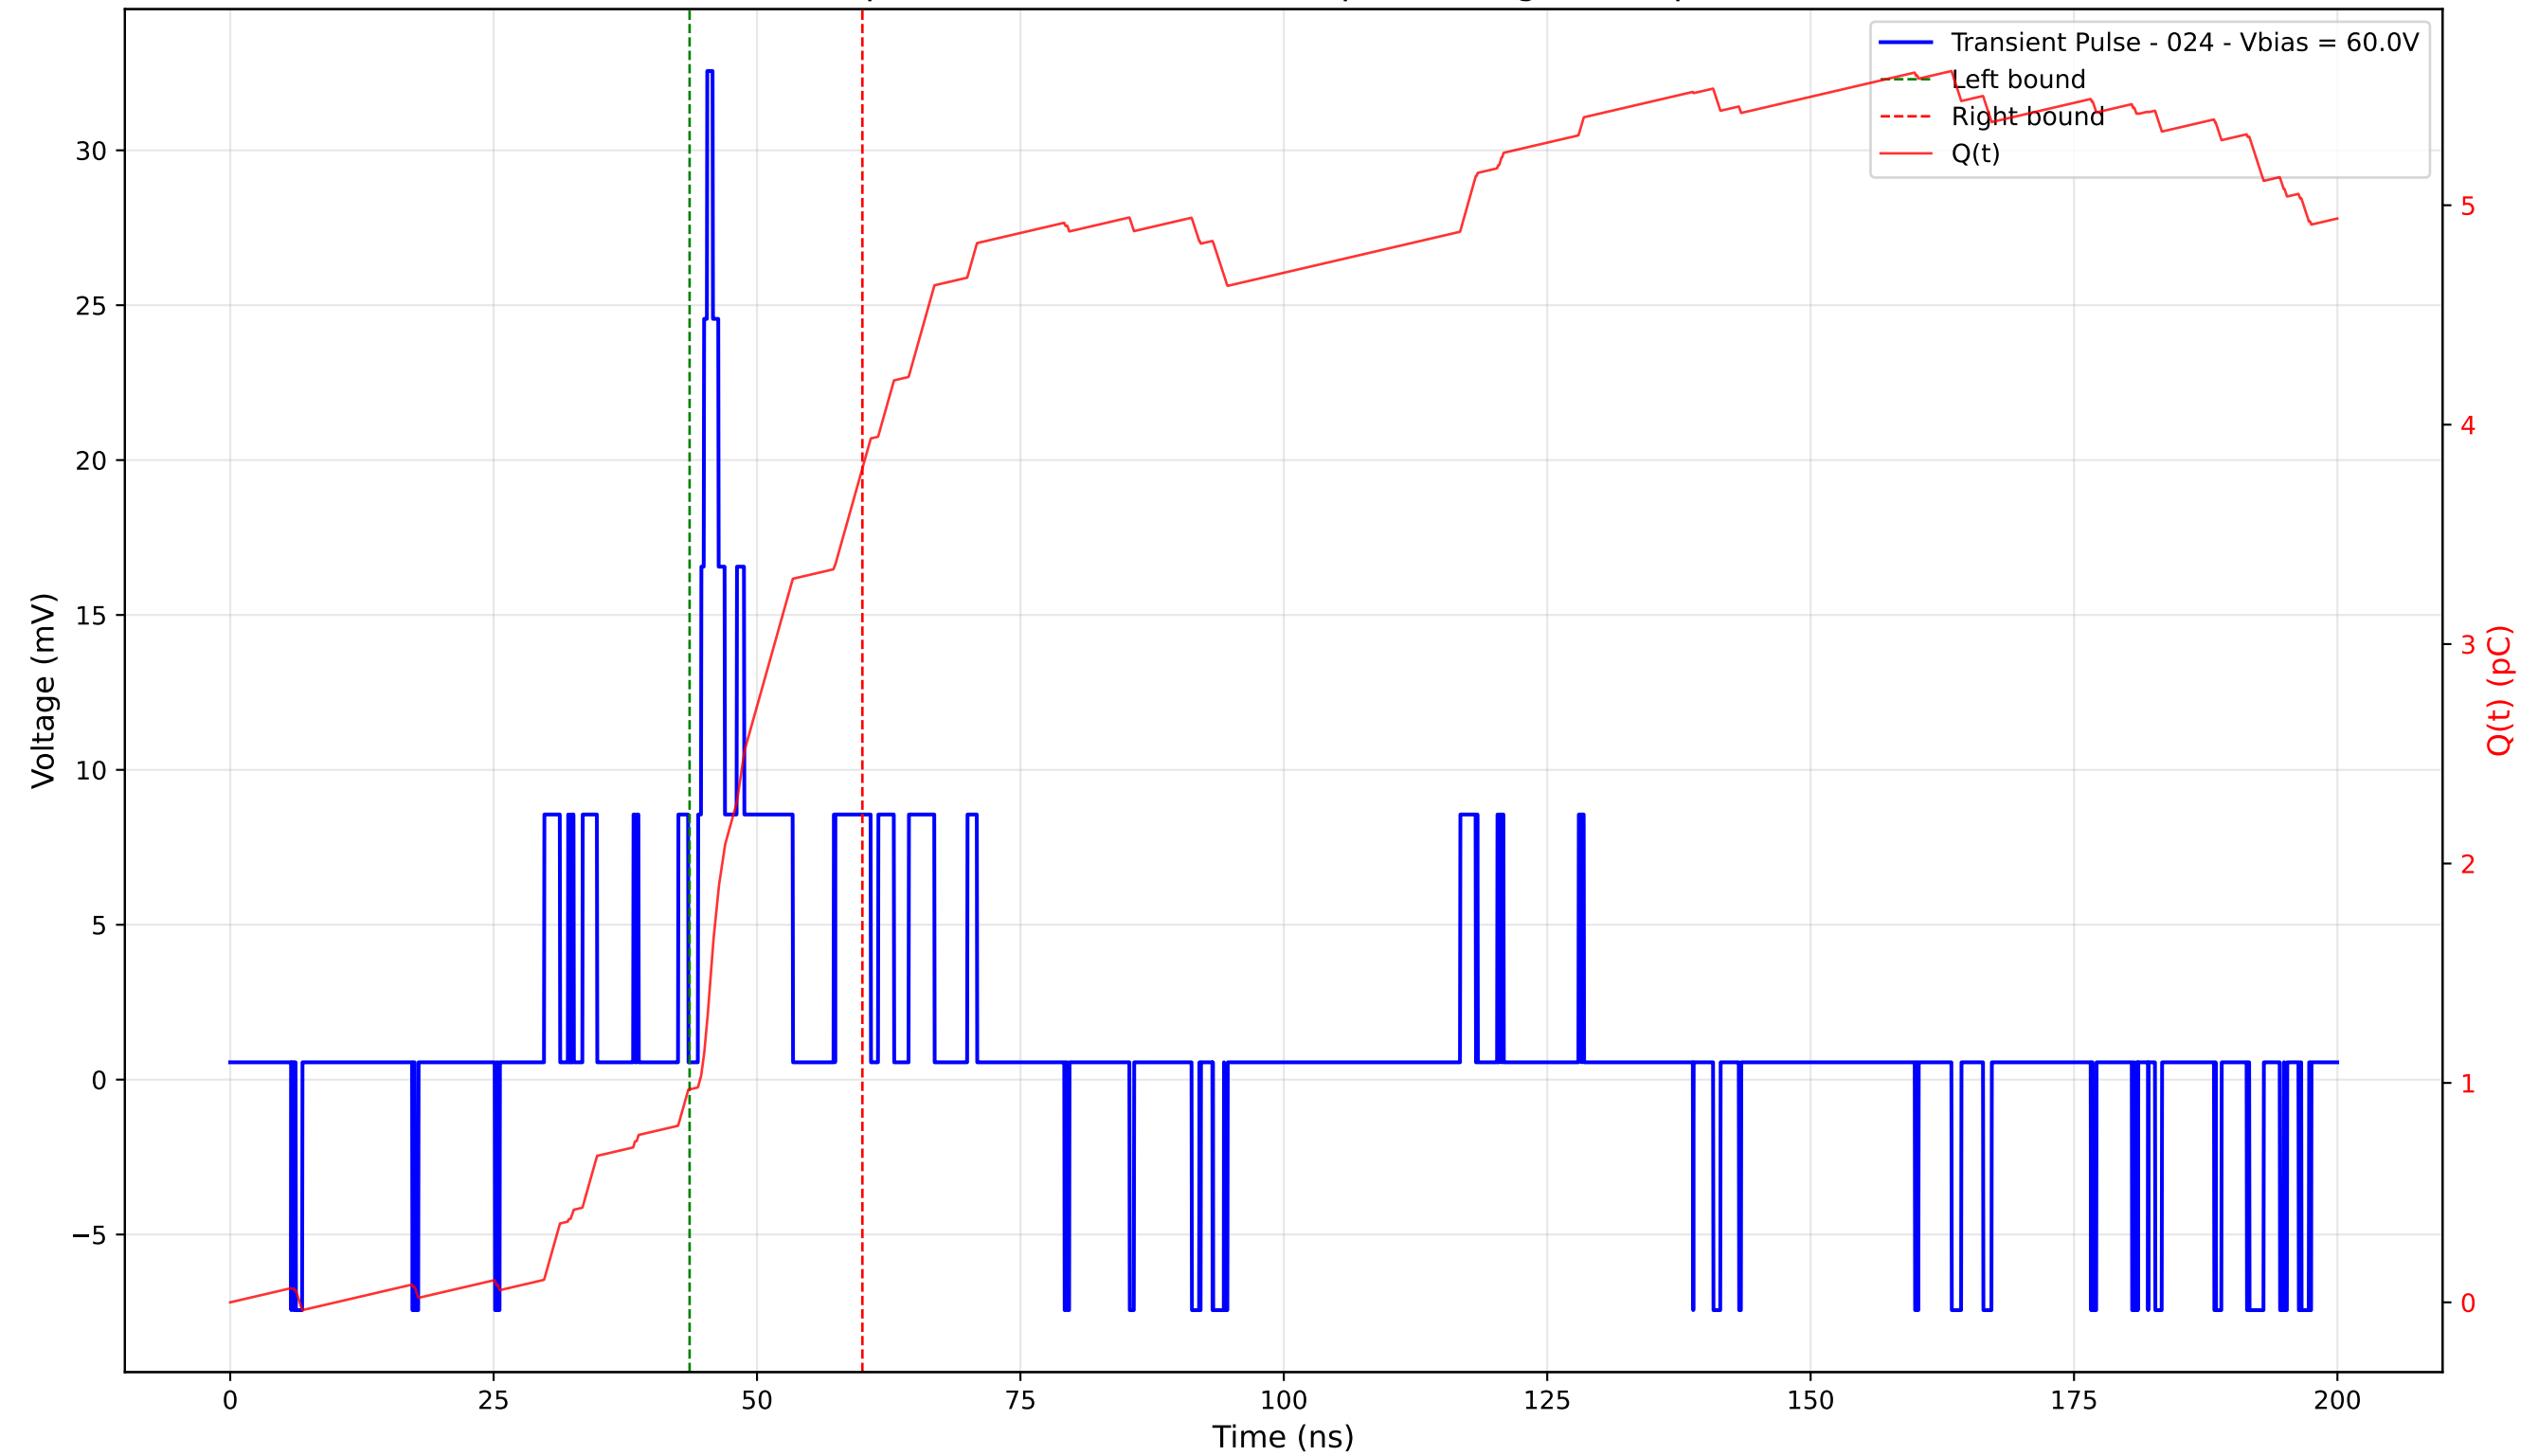


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 2.93 pC - Rise Time: 0.00 ns (N/A)

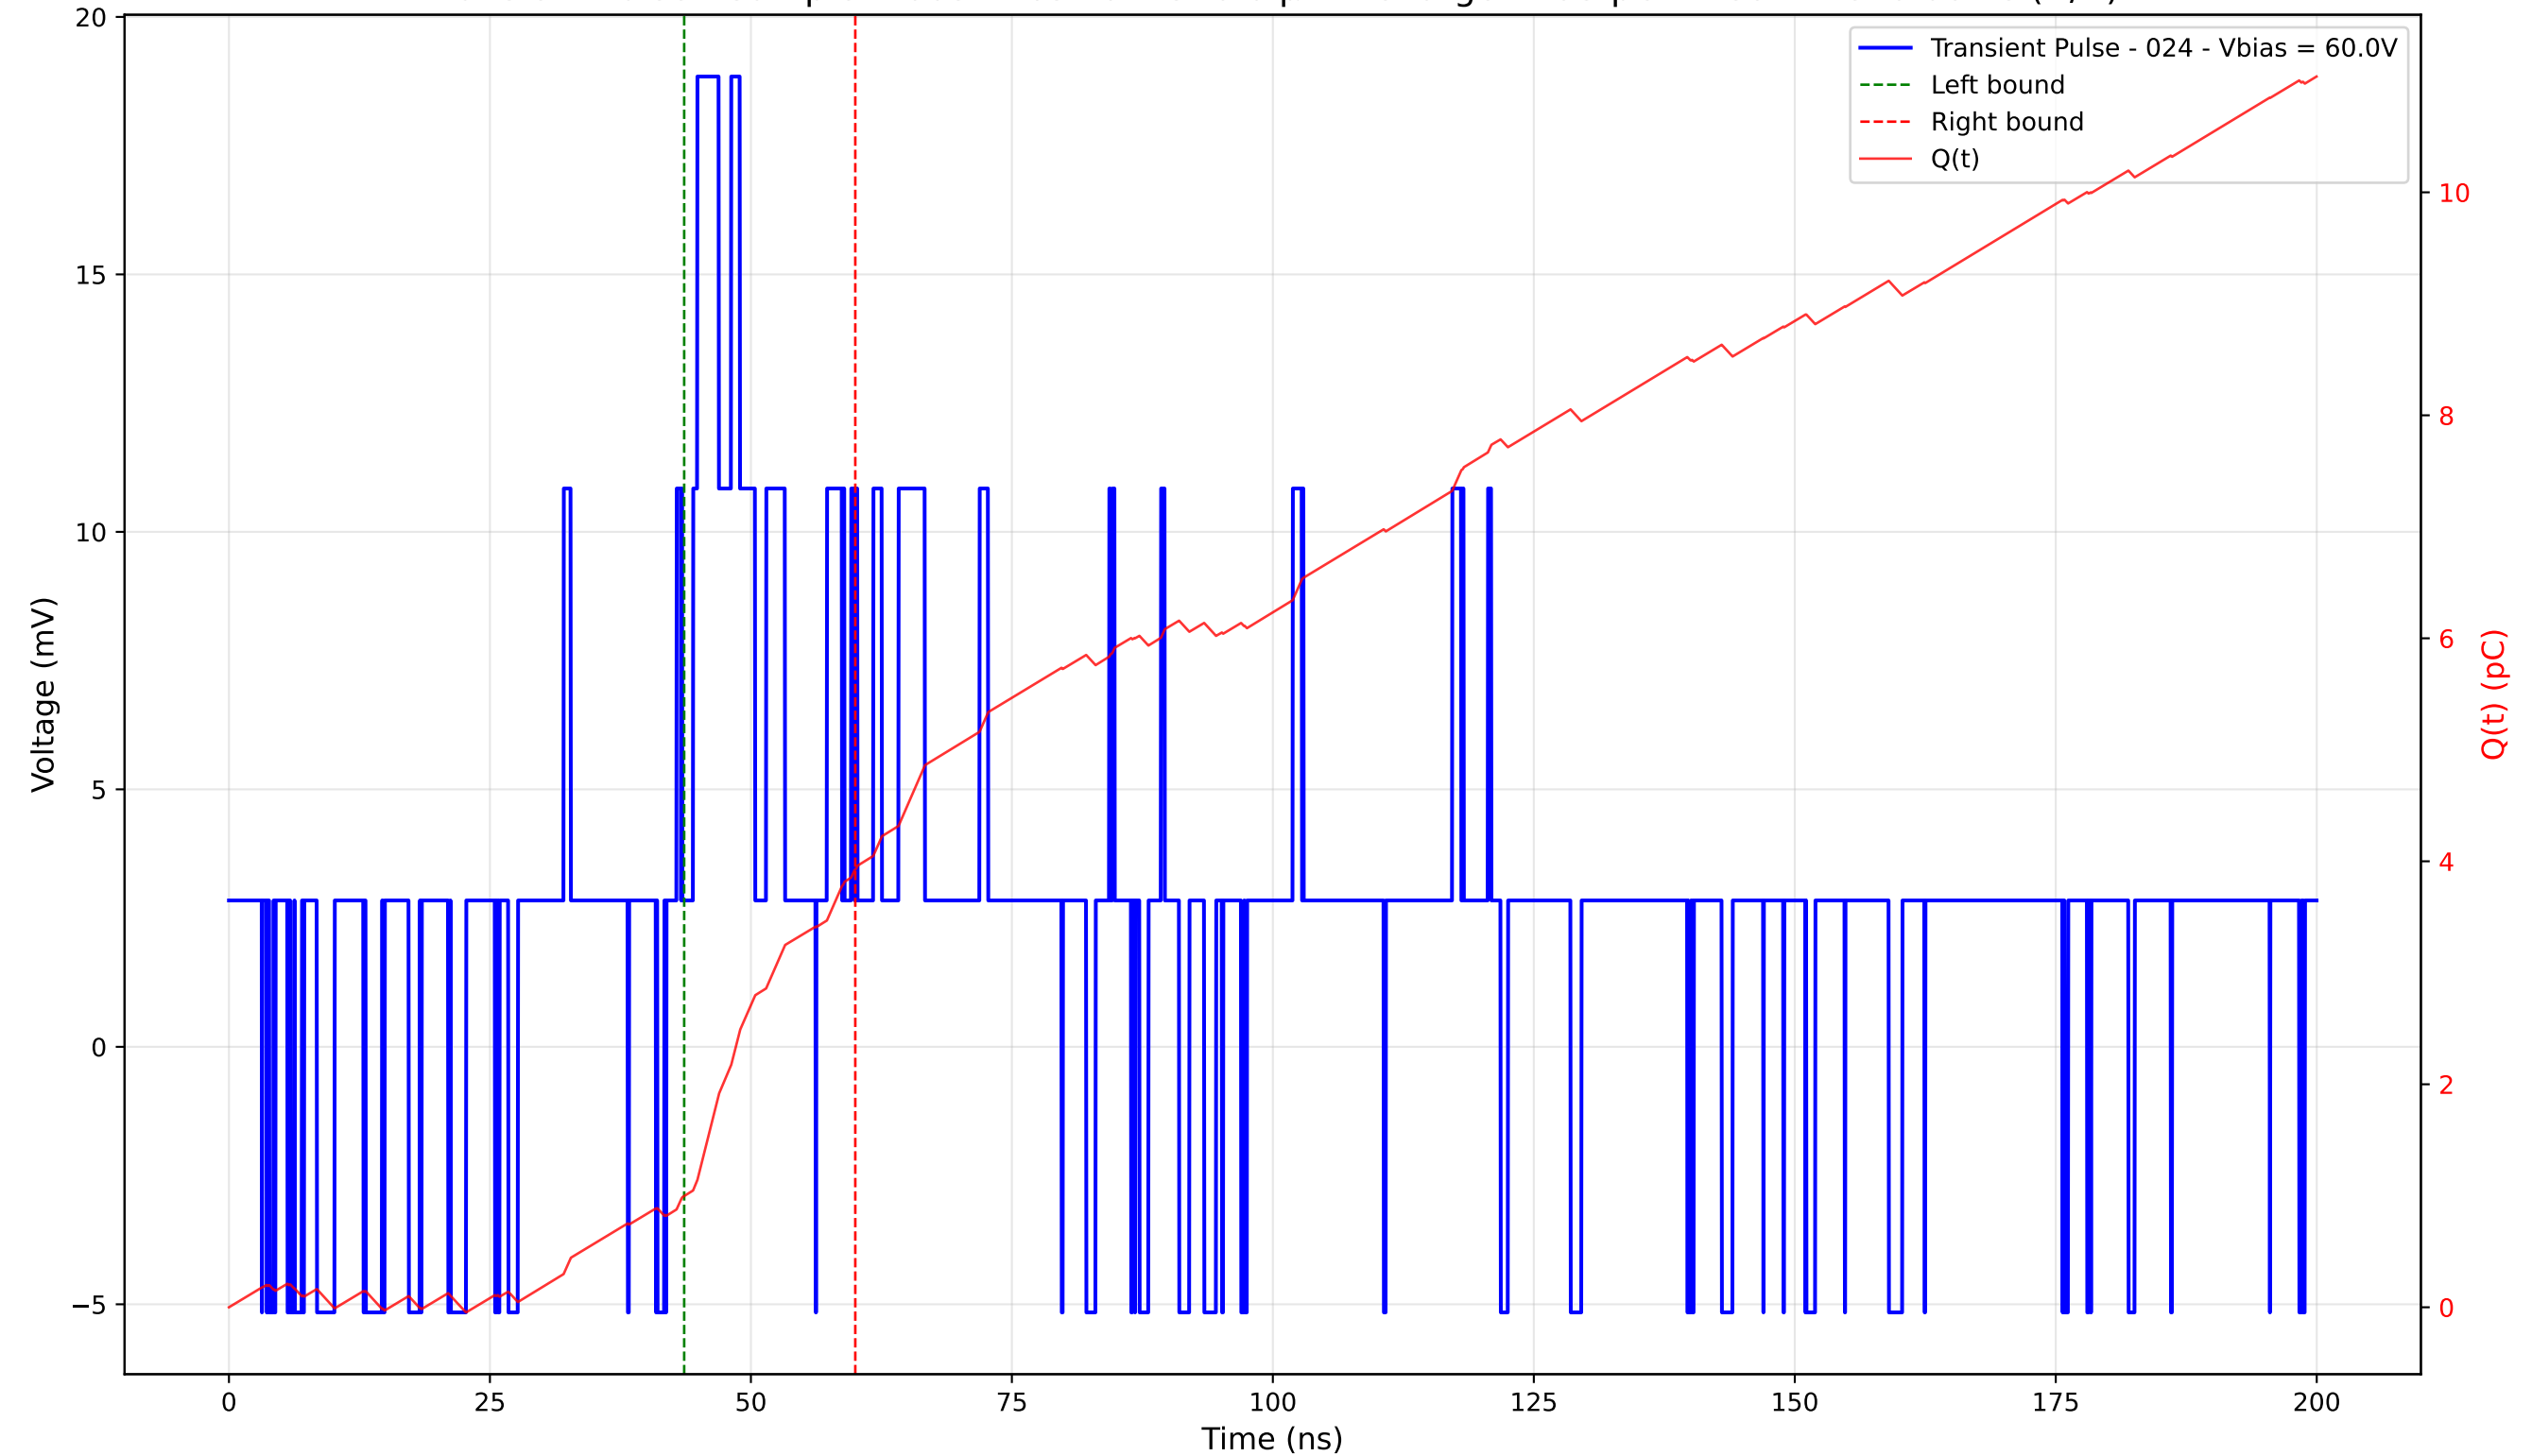


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 3.01 pC - Rise Time: 0.92 ns

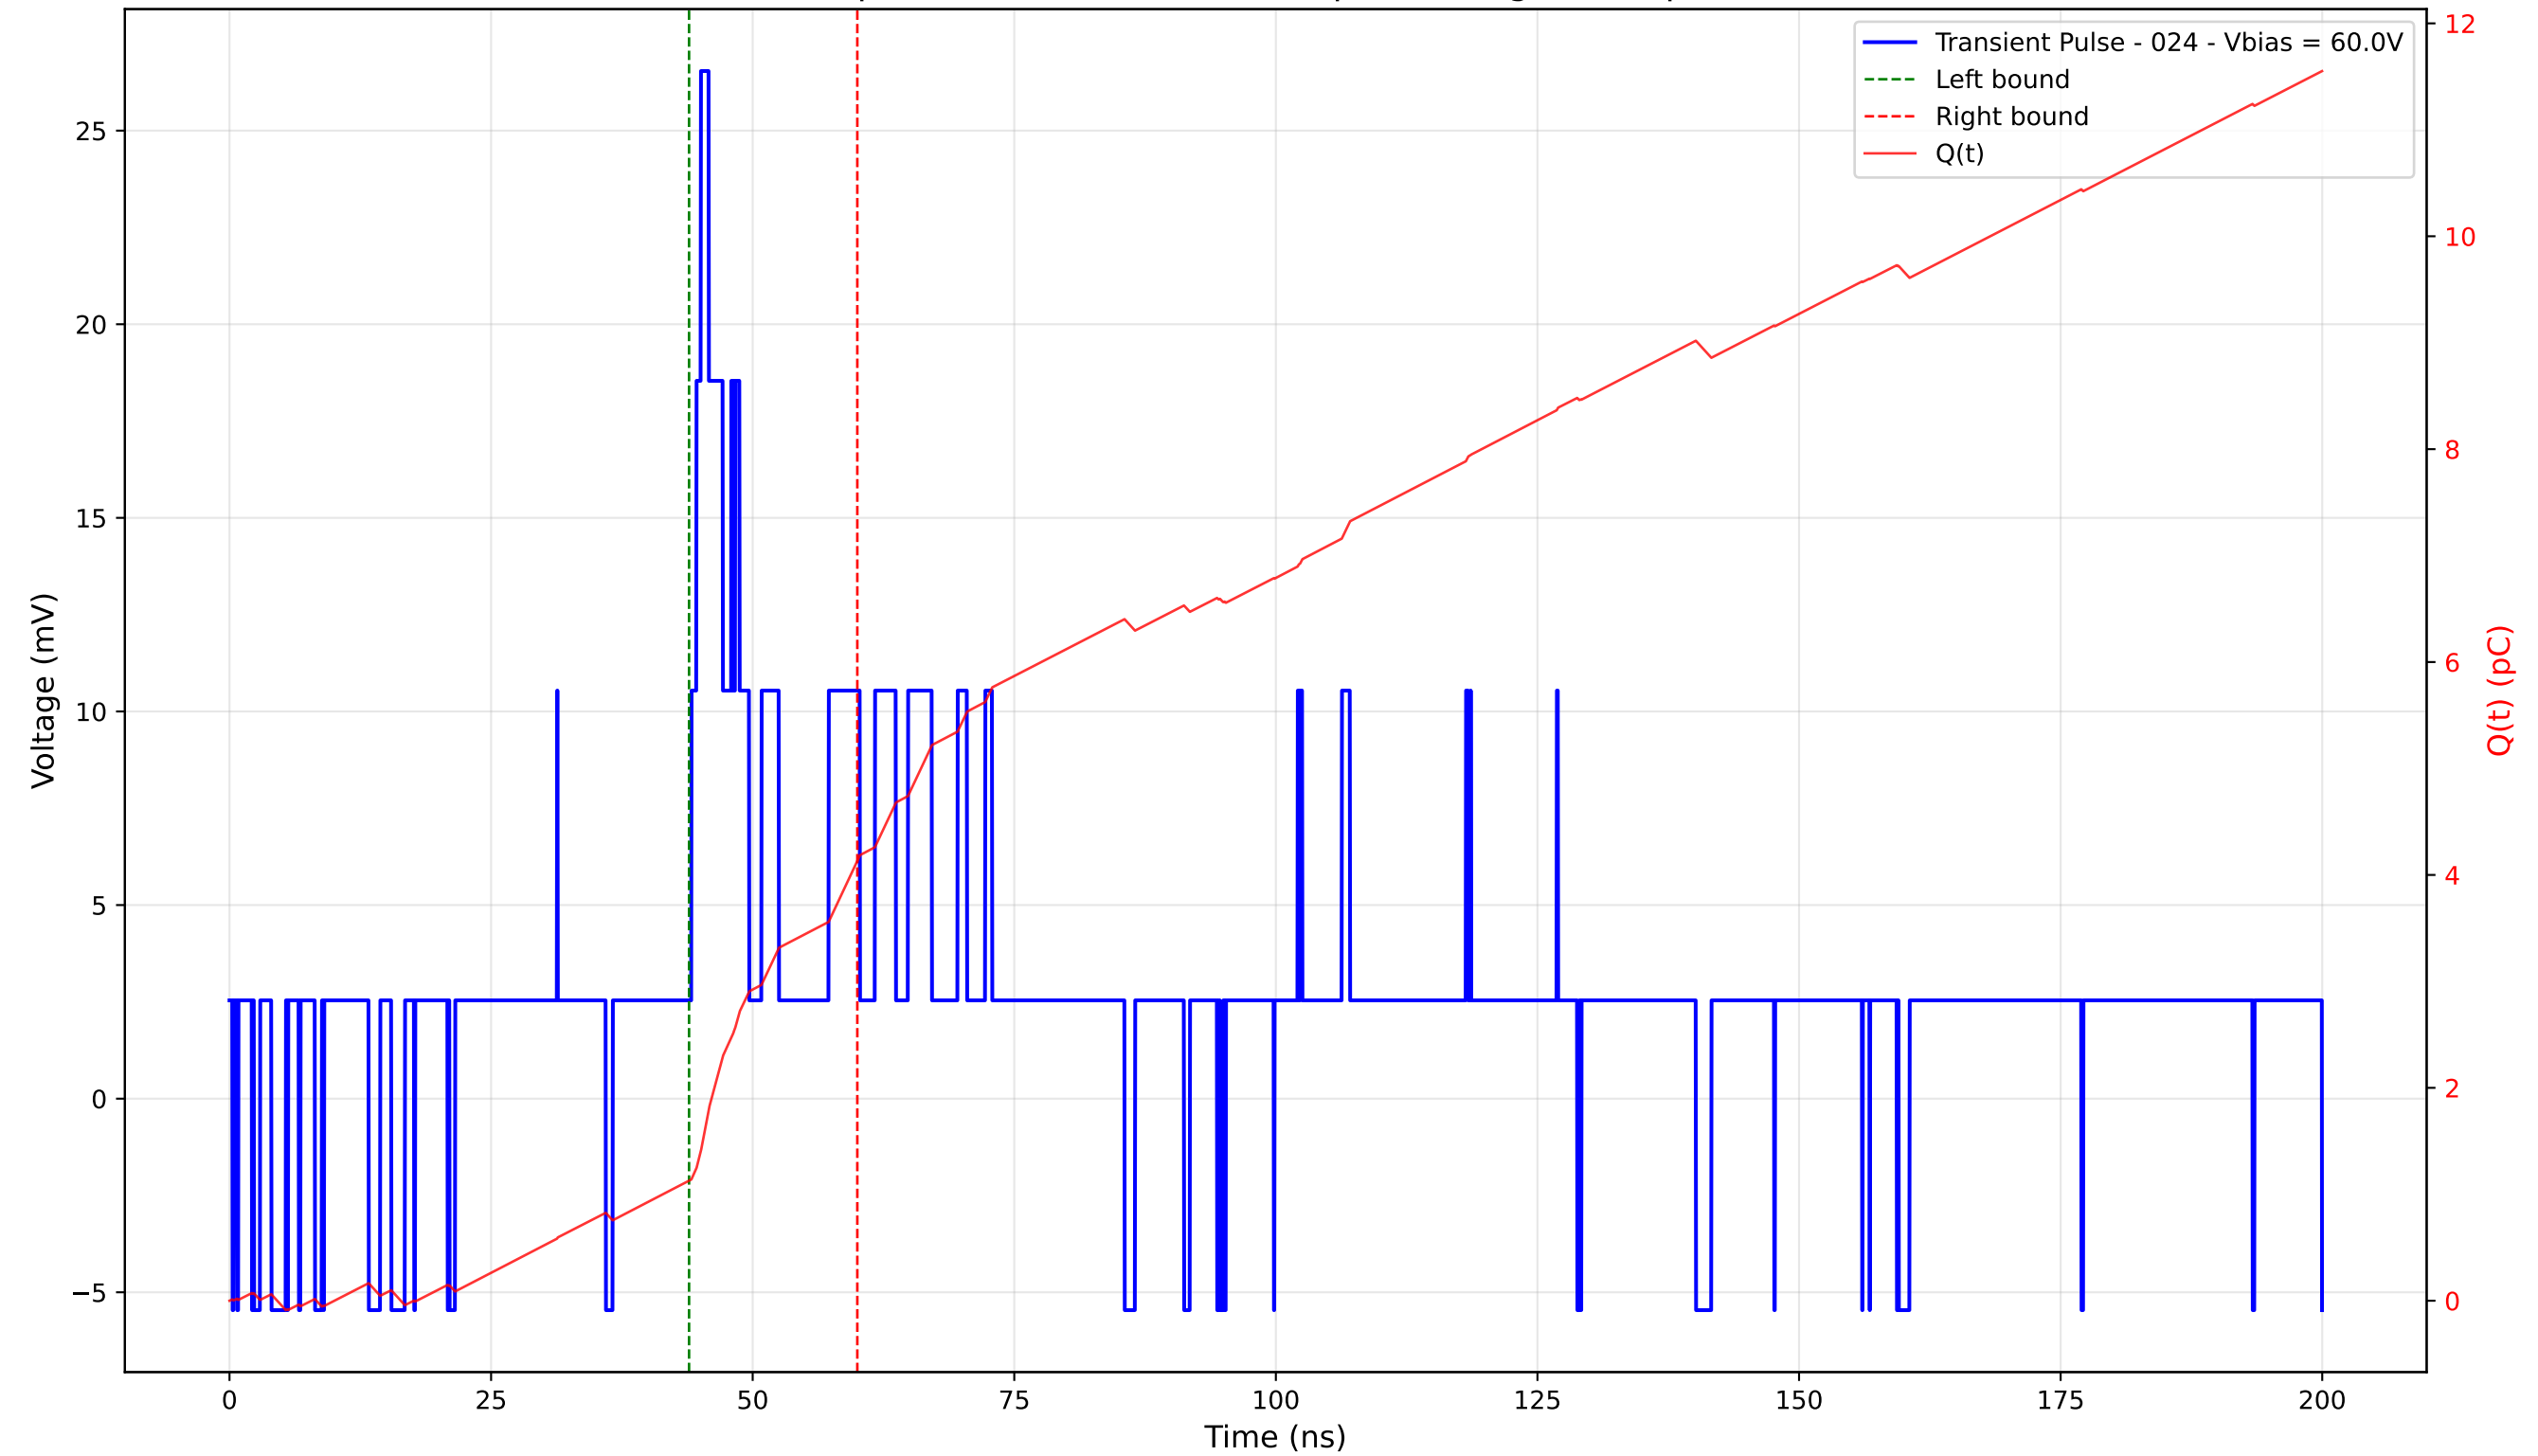


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 2.71 pC - Rise Time: 1.04 ns

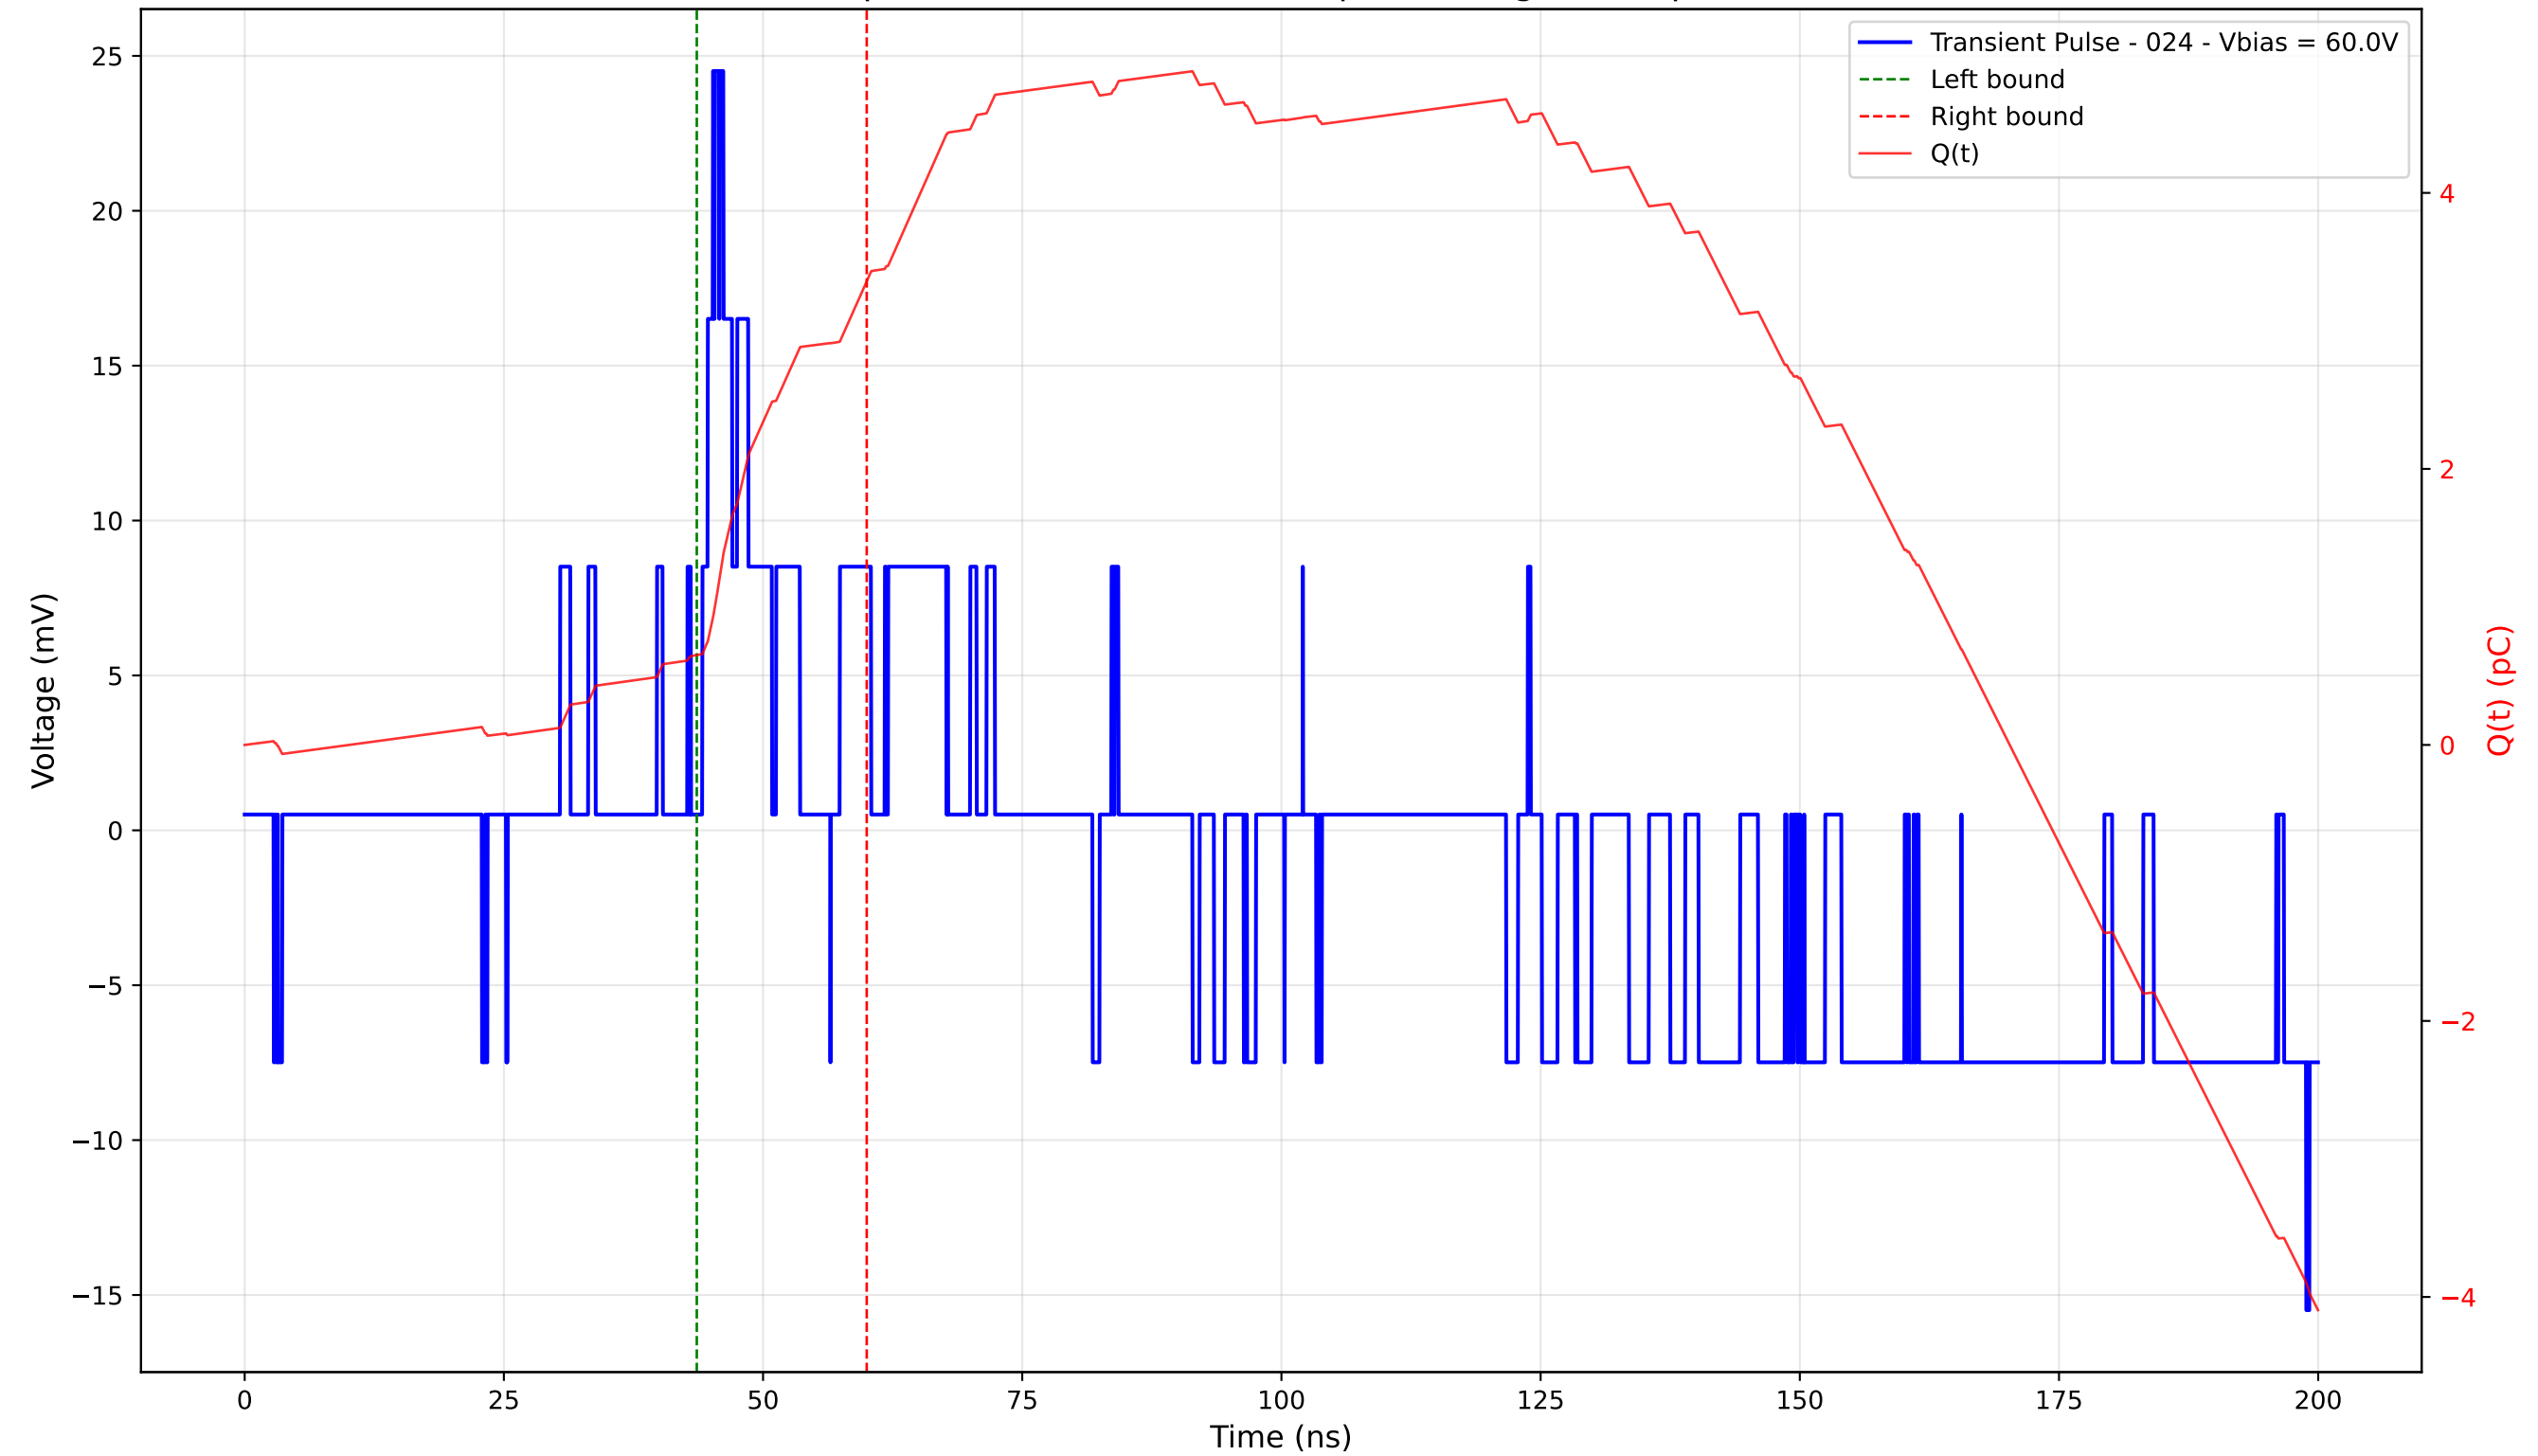


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 2.64 pC - Rise Time: 0.00 ns (N/A)

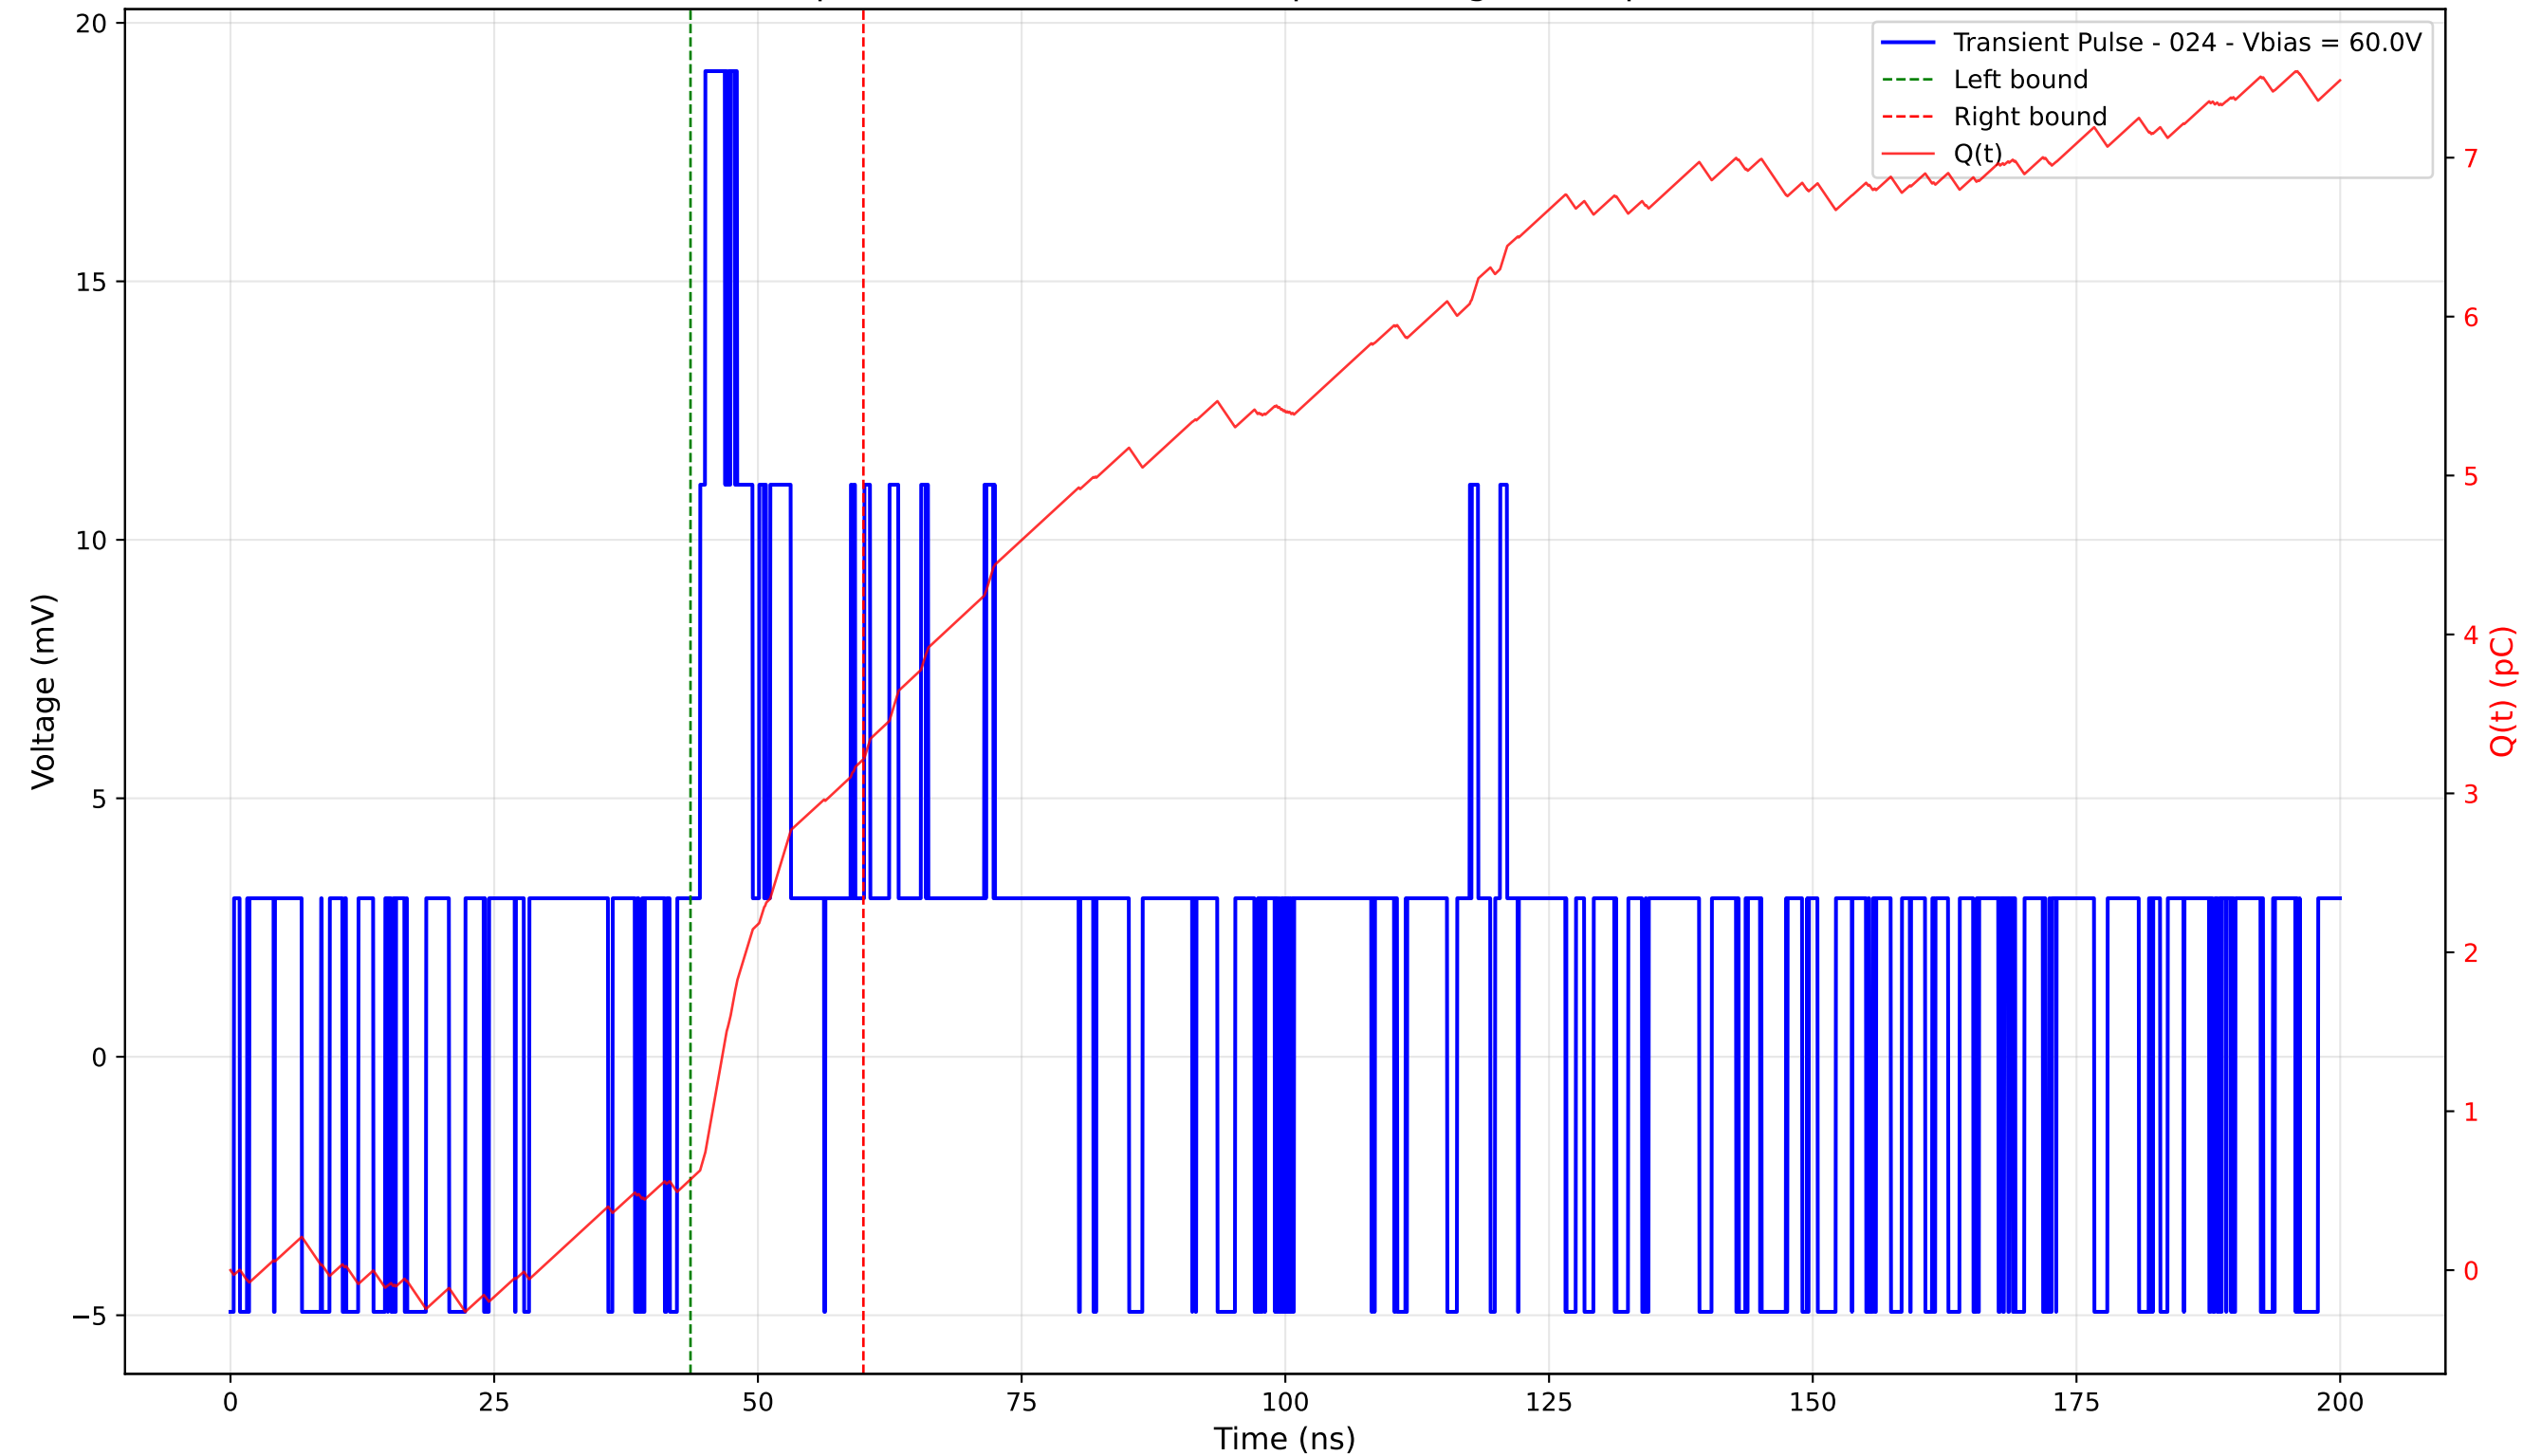


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 2.40 pC - Rise Time: 1.25 ns

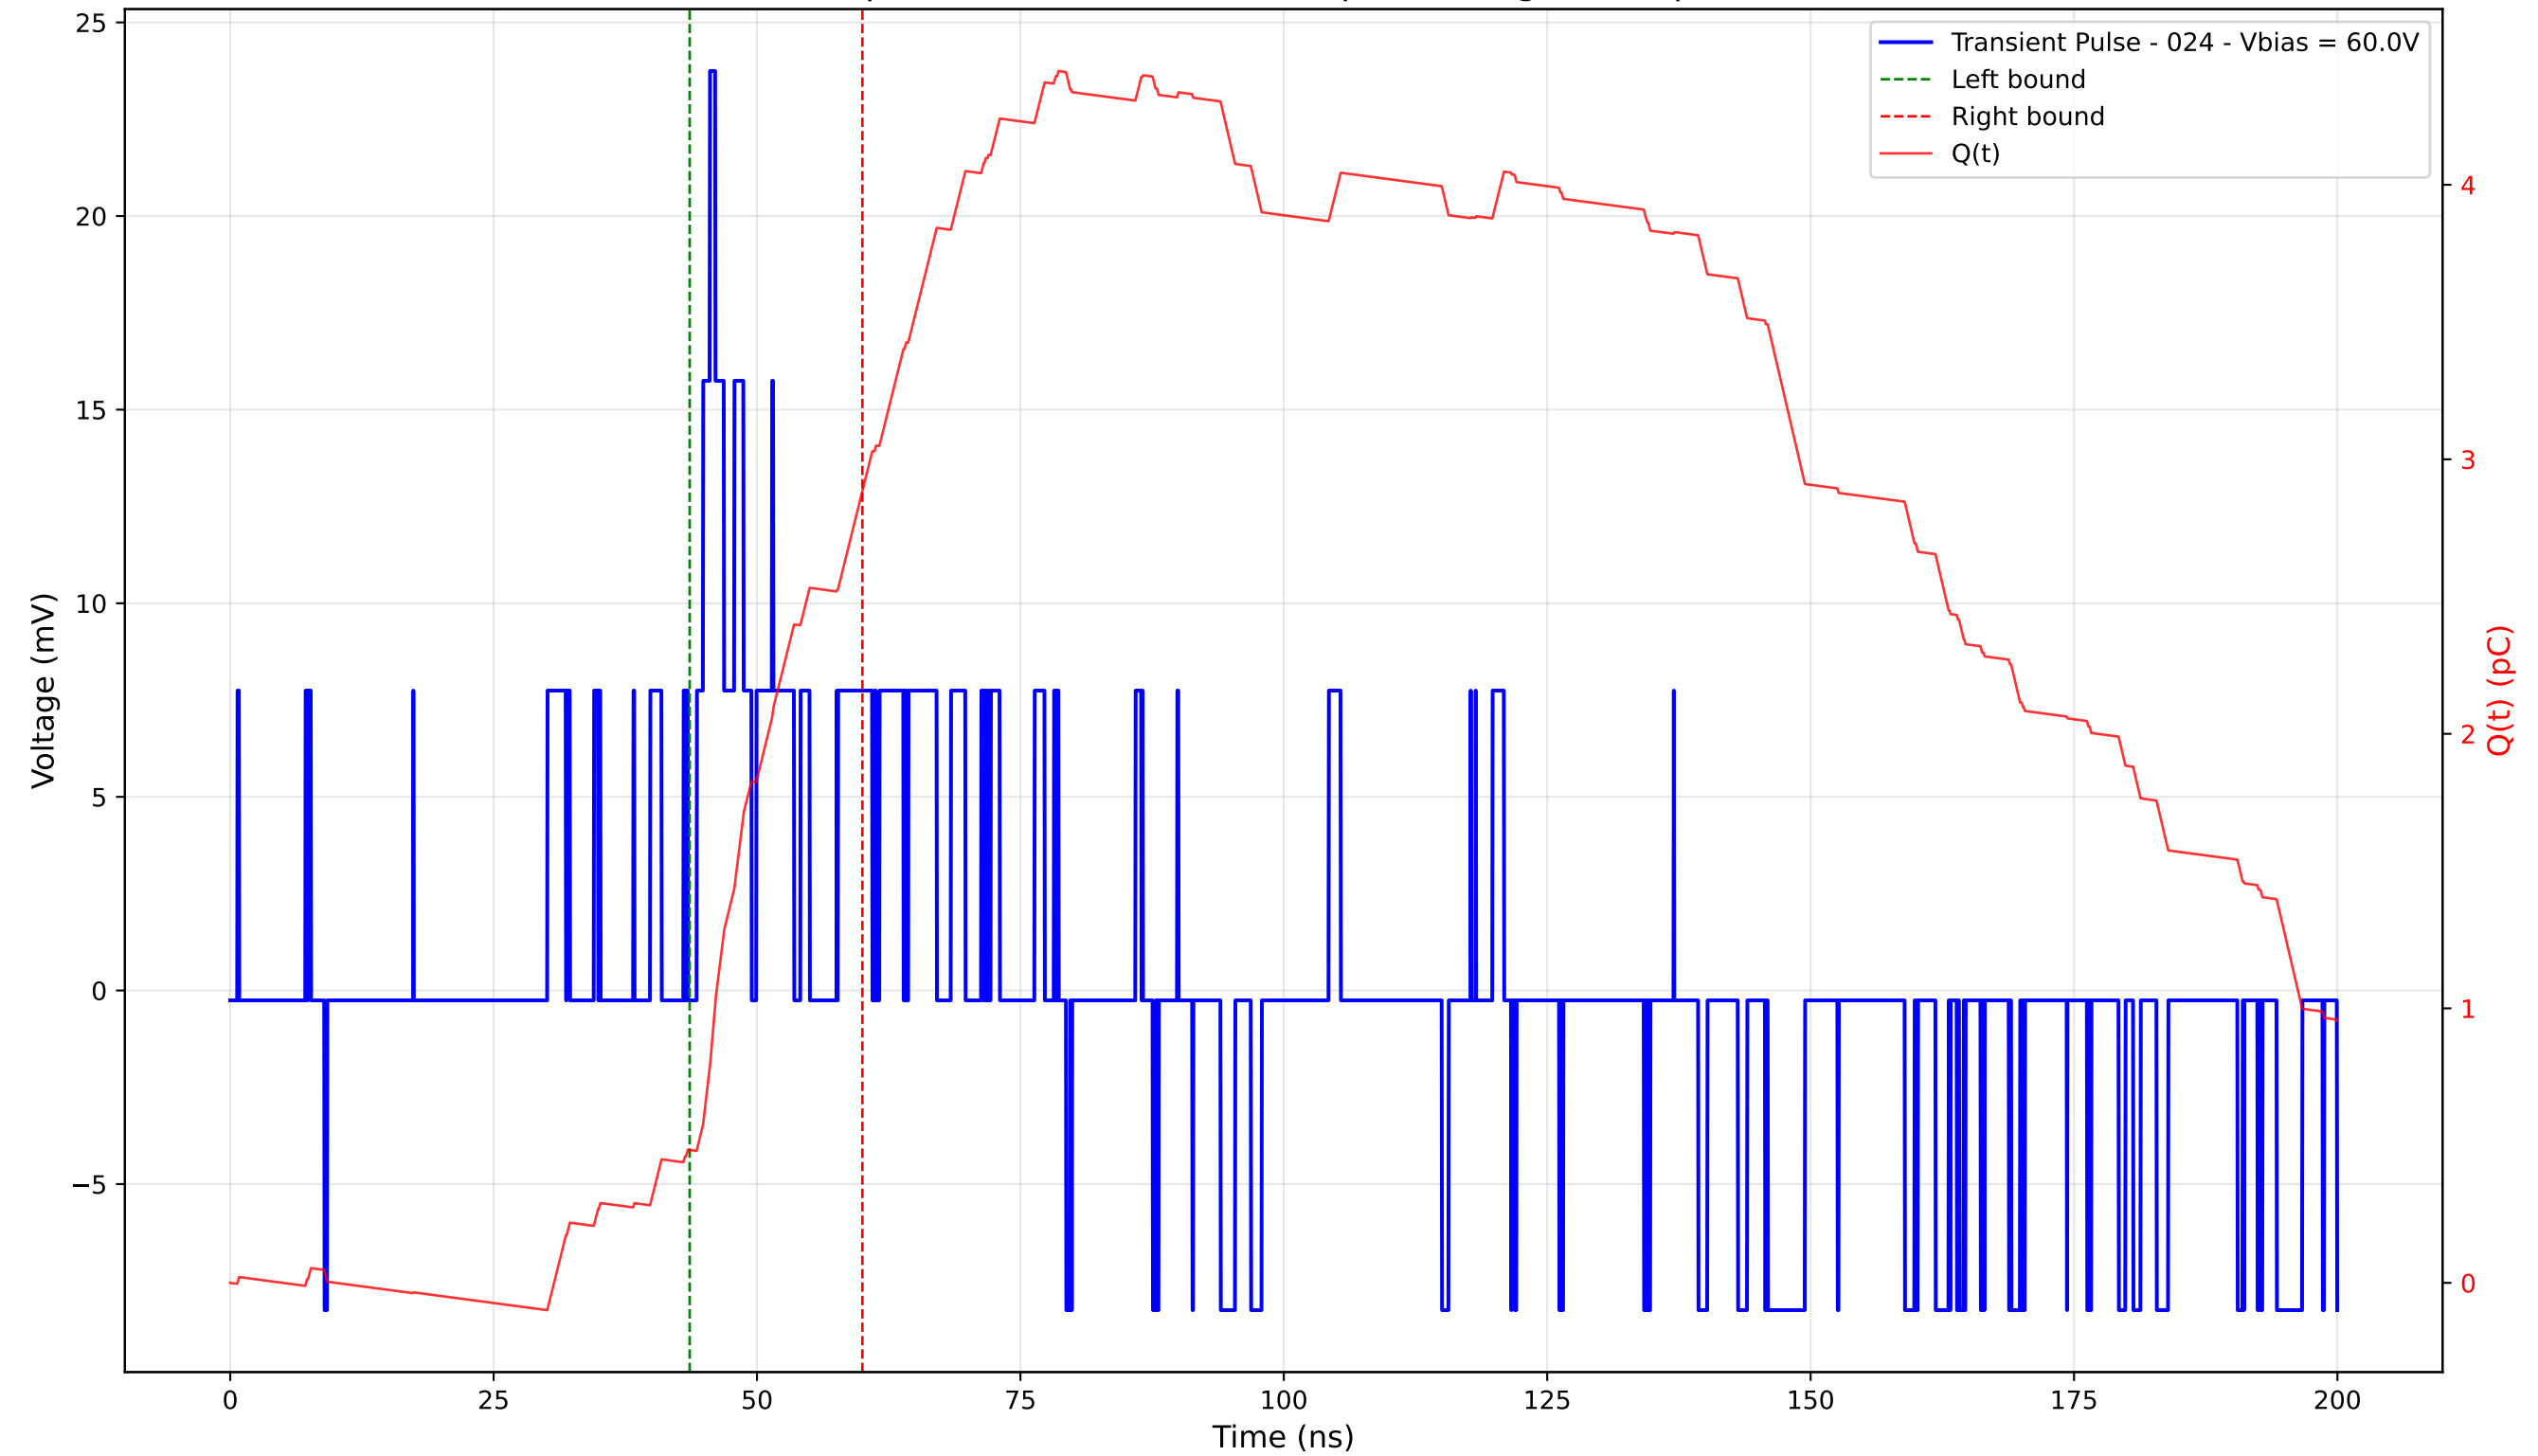


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 2.15 pC - Rise Time: 0.96 ns

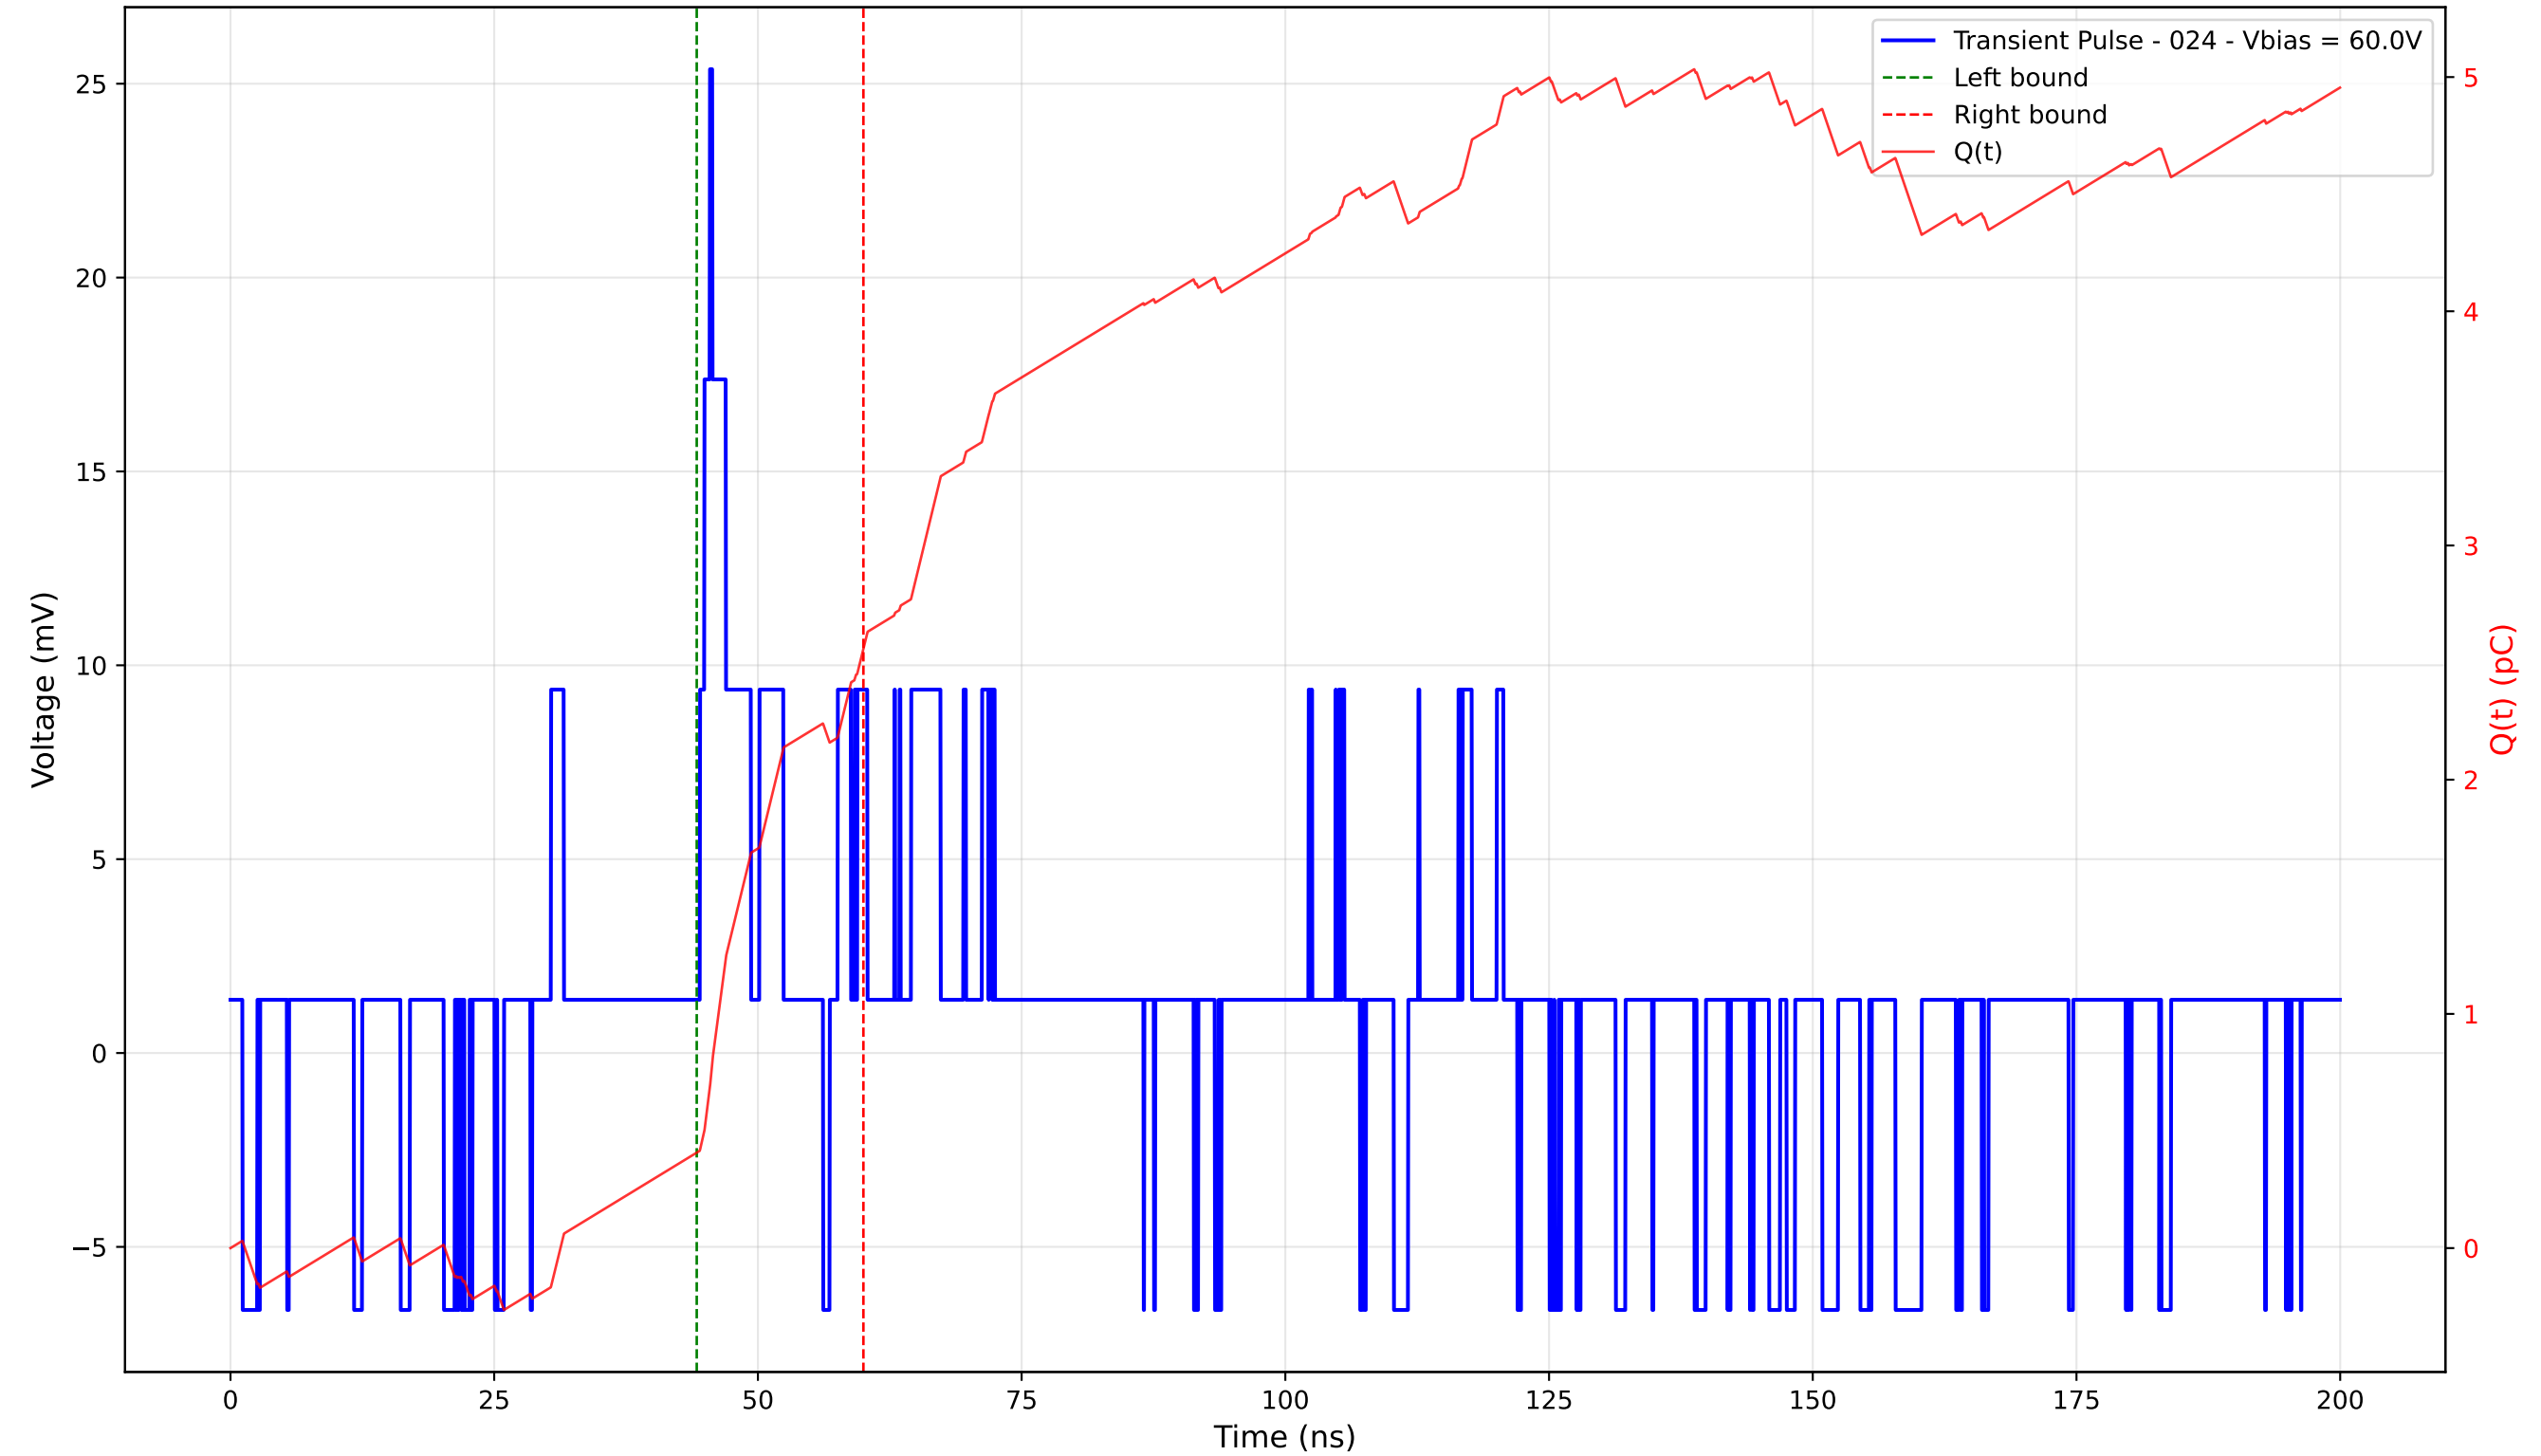


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 2.98 pC - Rise Time: 0.82 ns

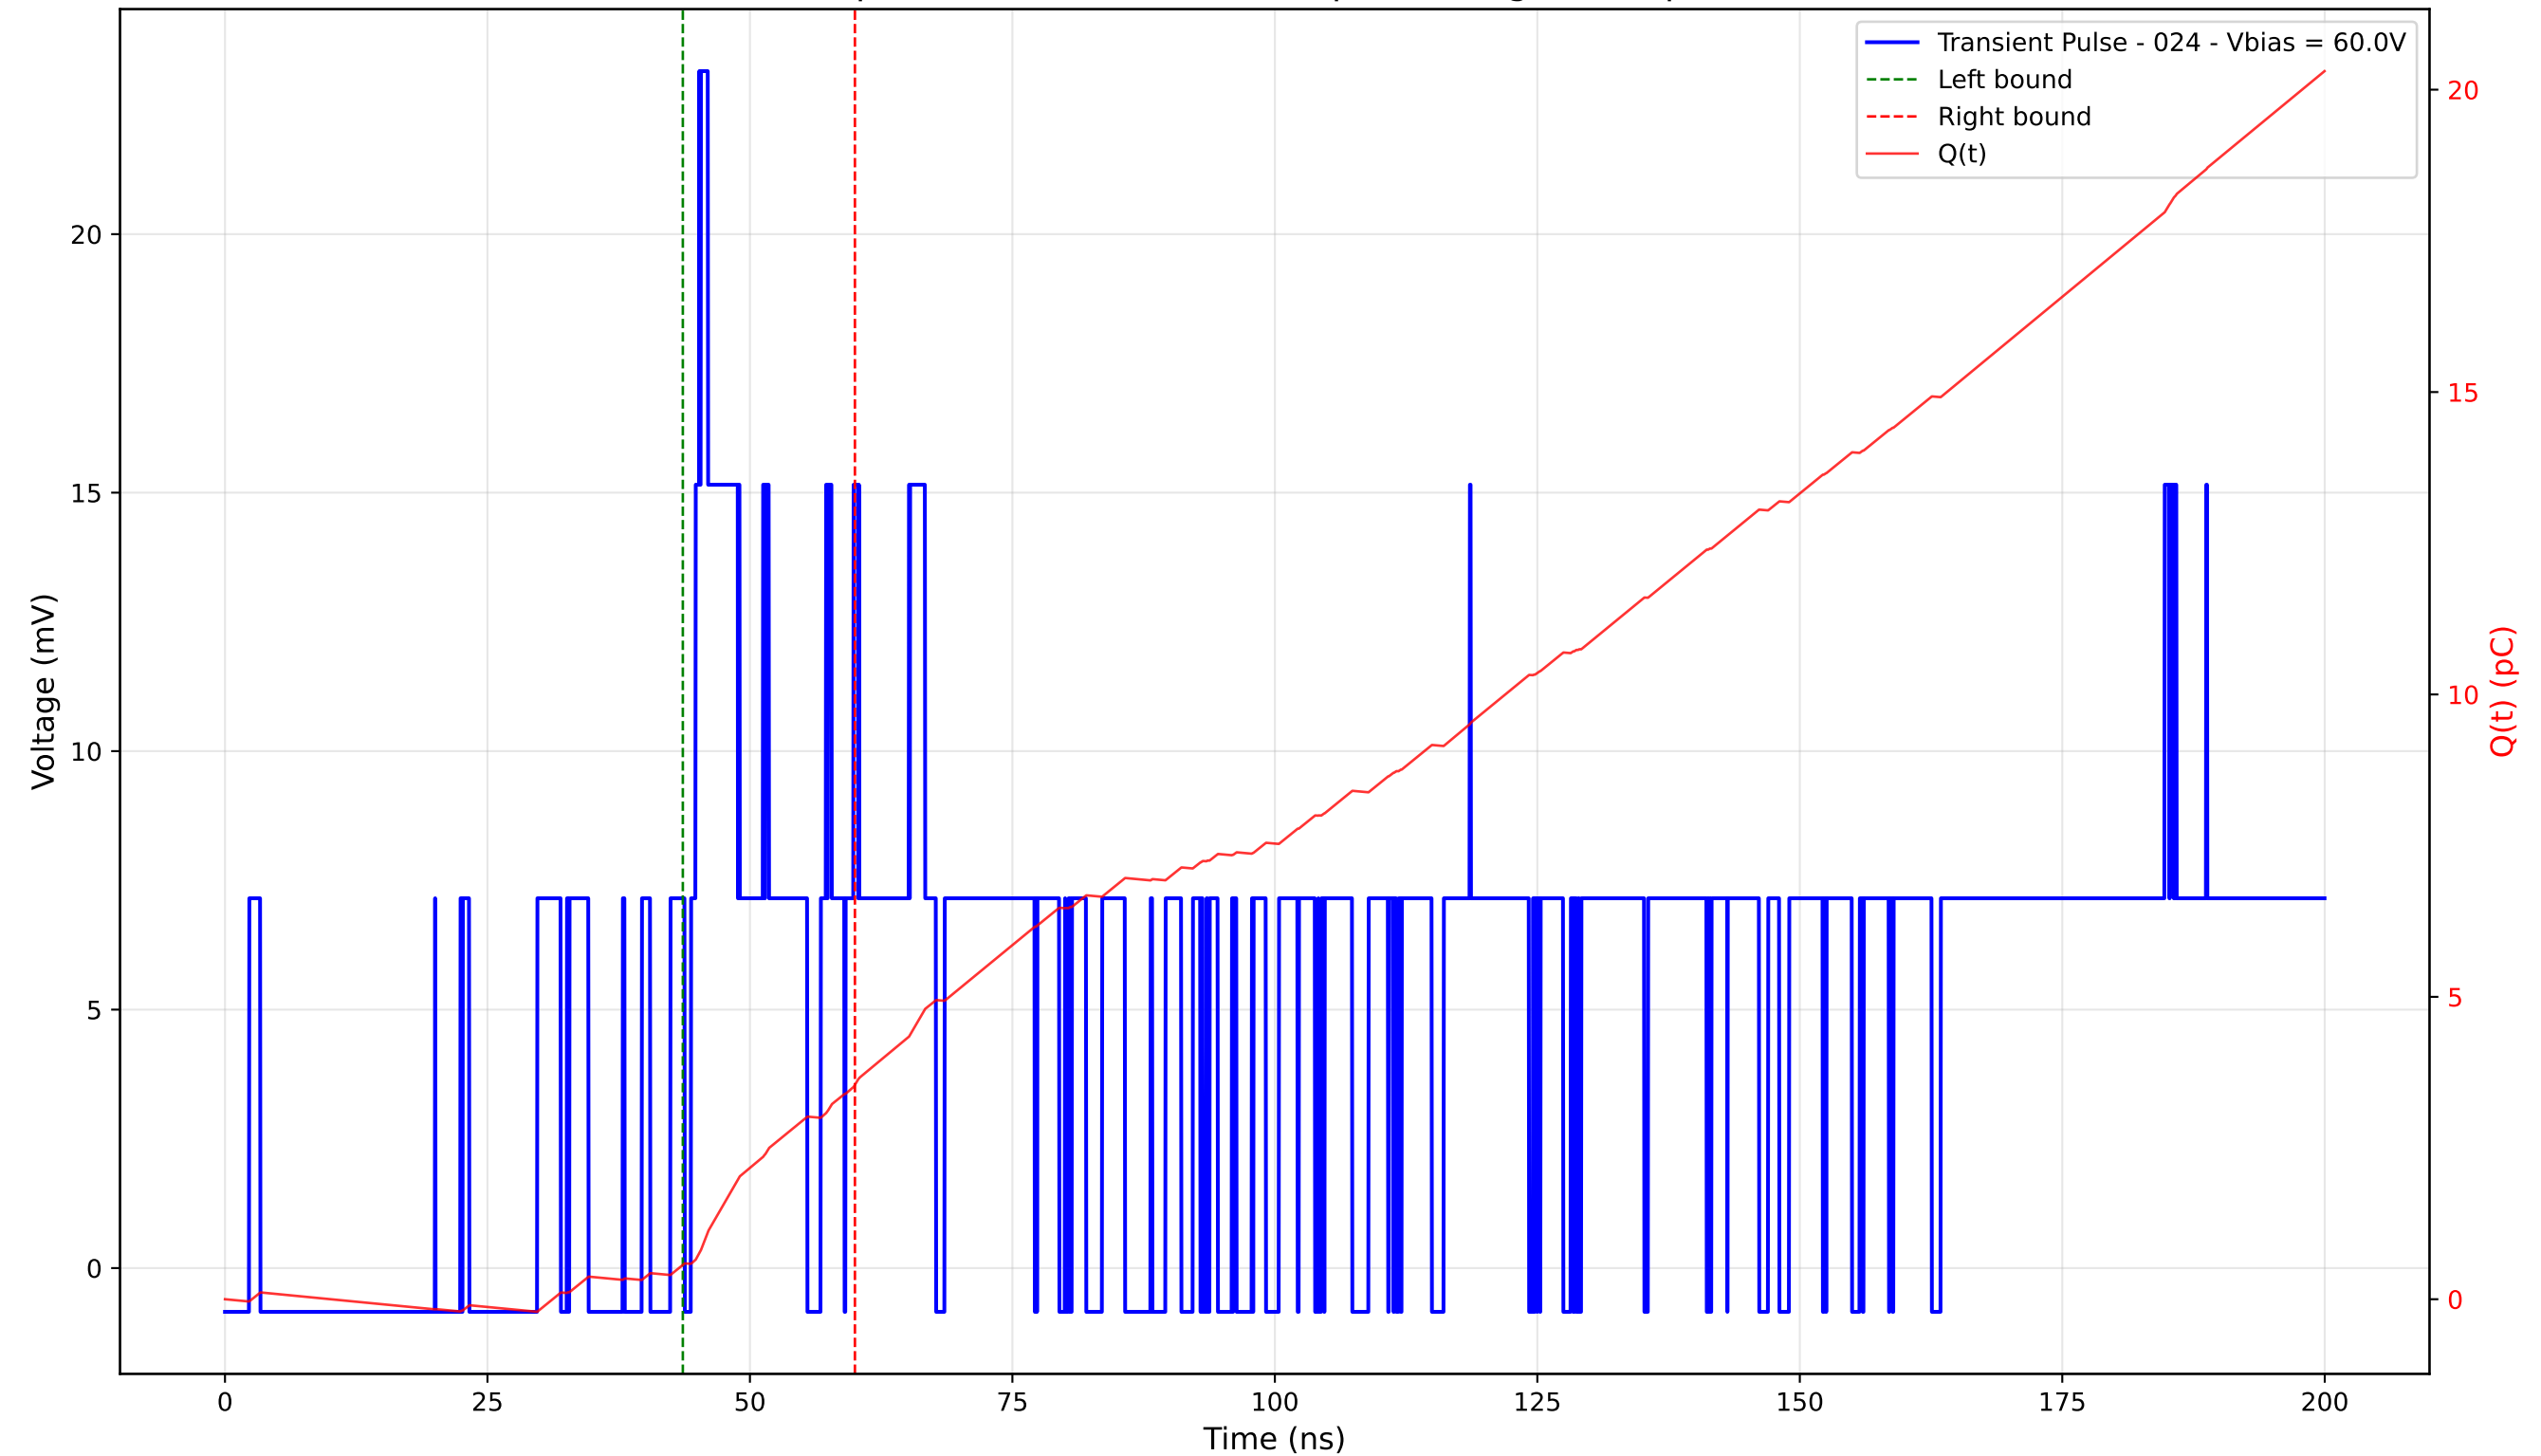


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 2.45 pC - Rise Time: 0.00 ns (N/A)

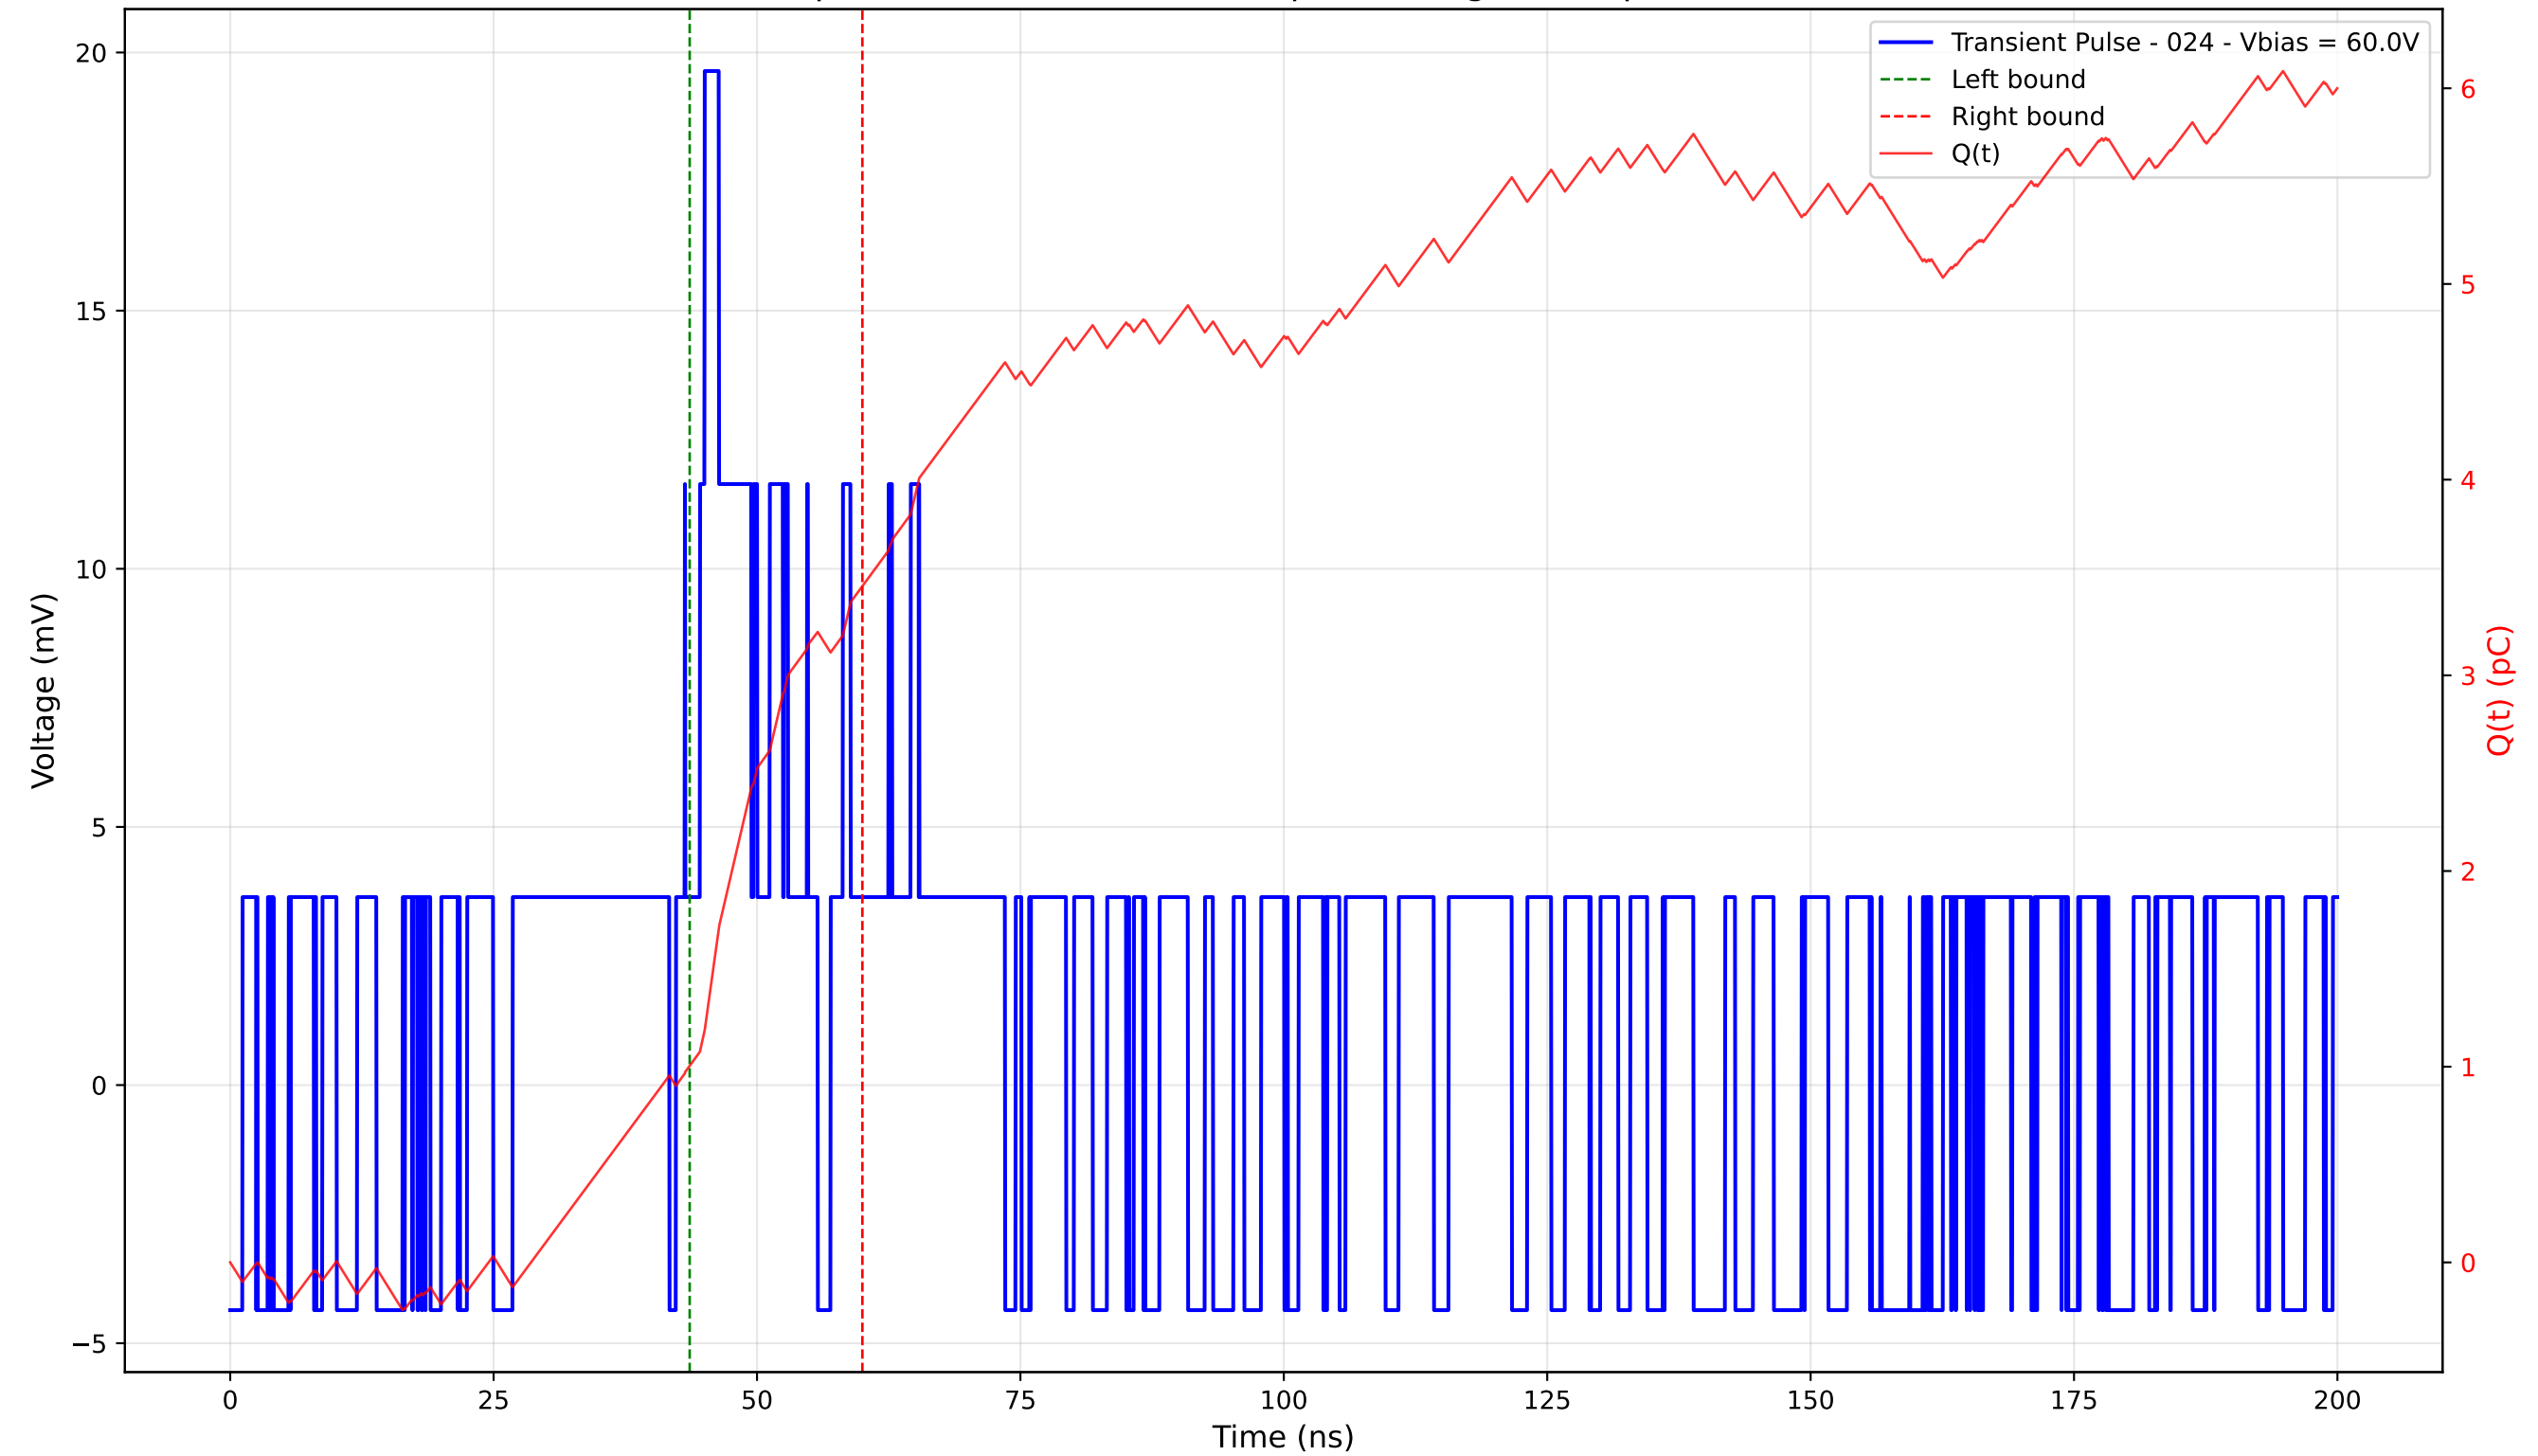


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 2.03 pC - Rise Time: 0.38 ns

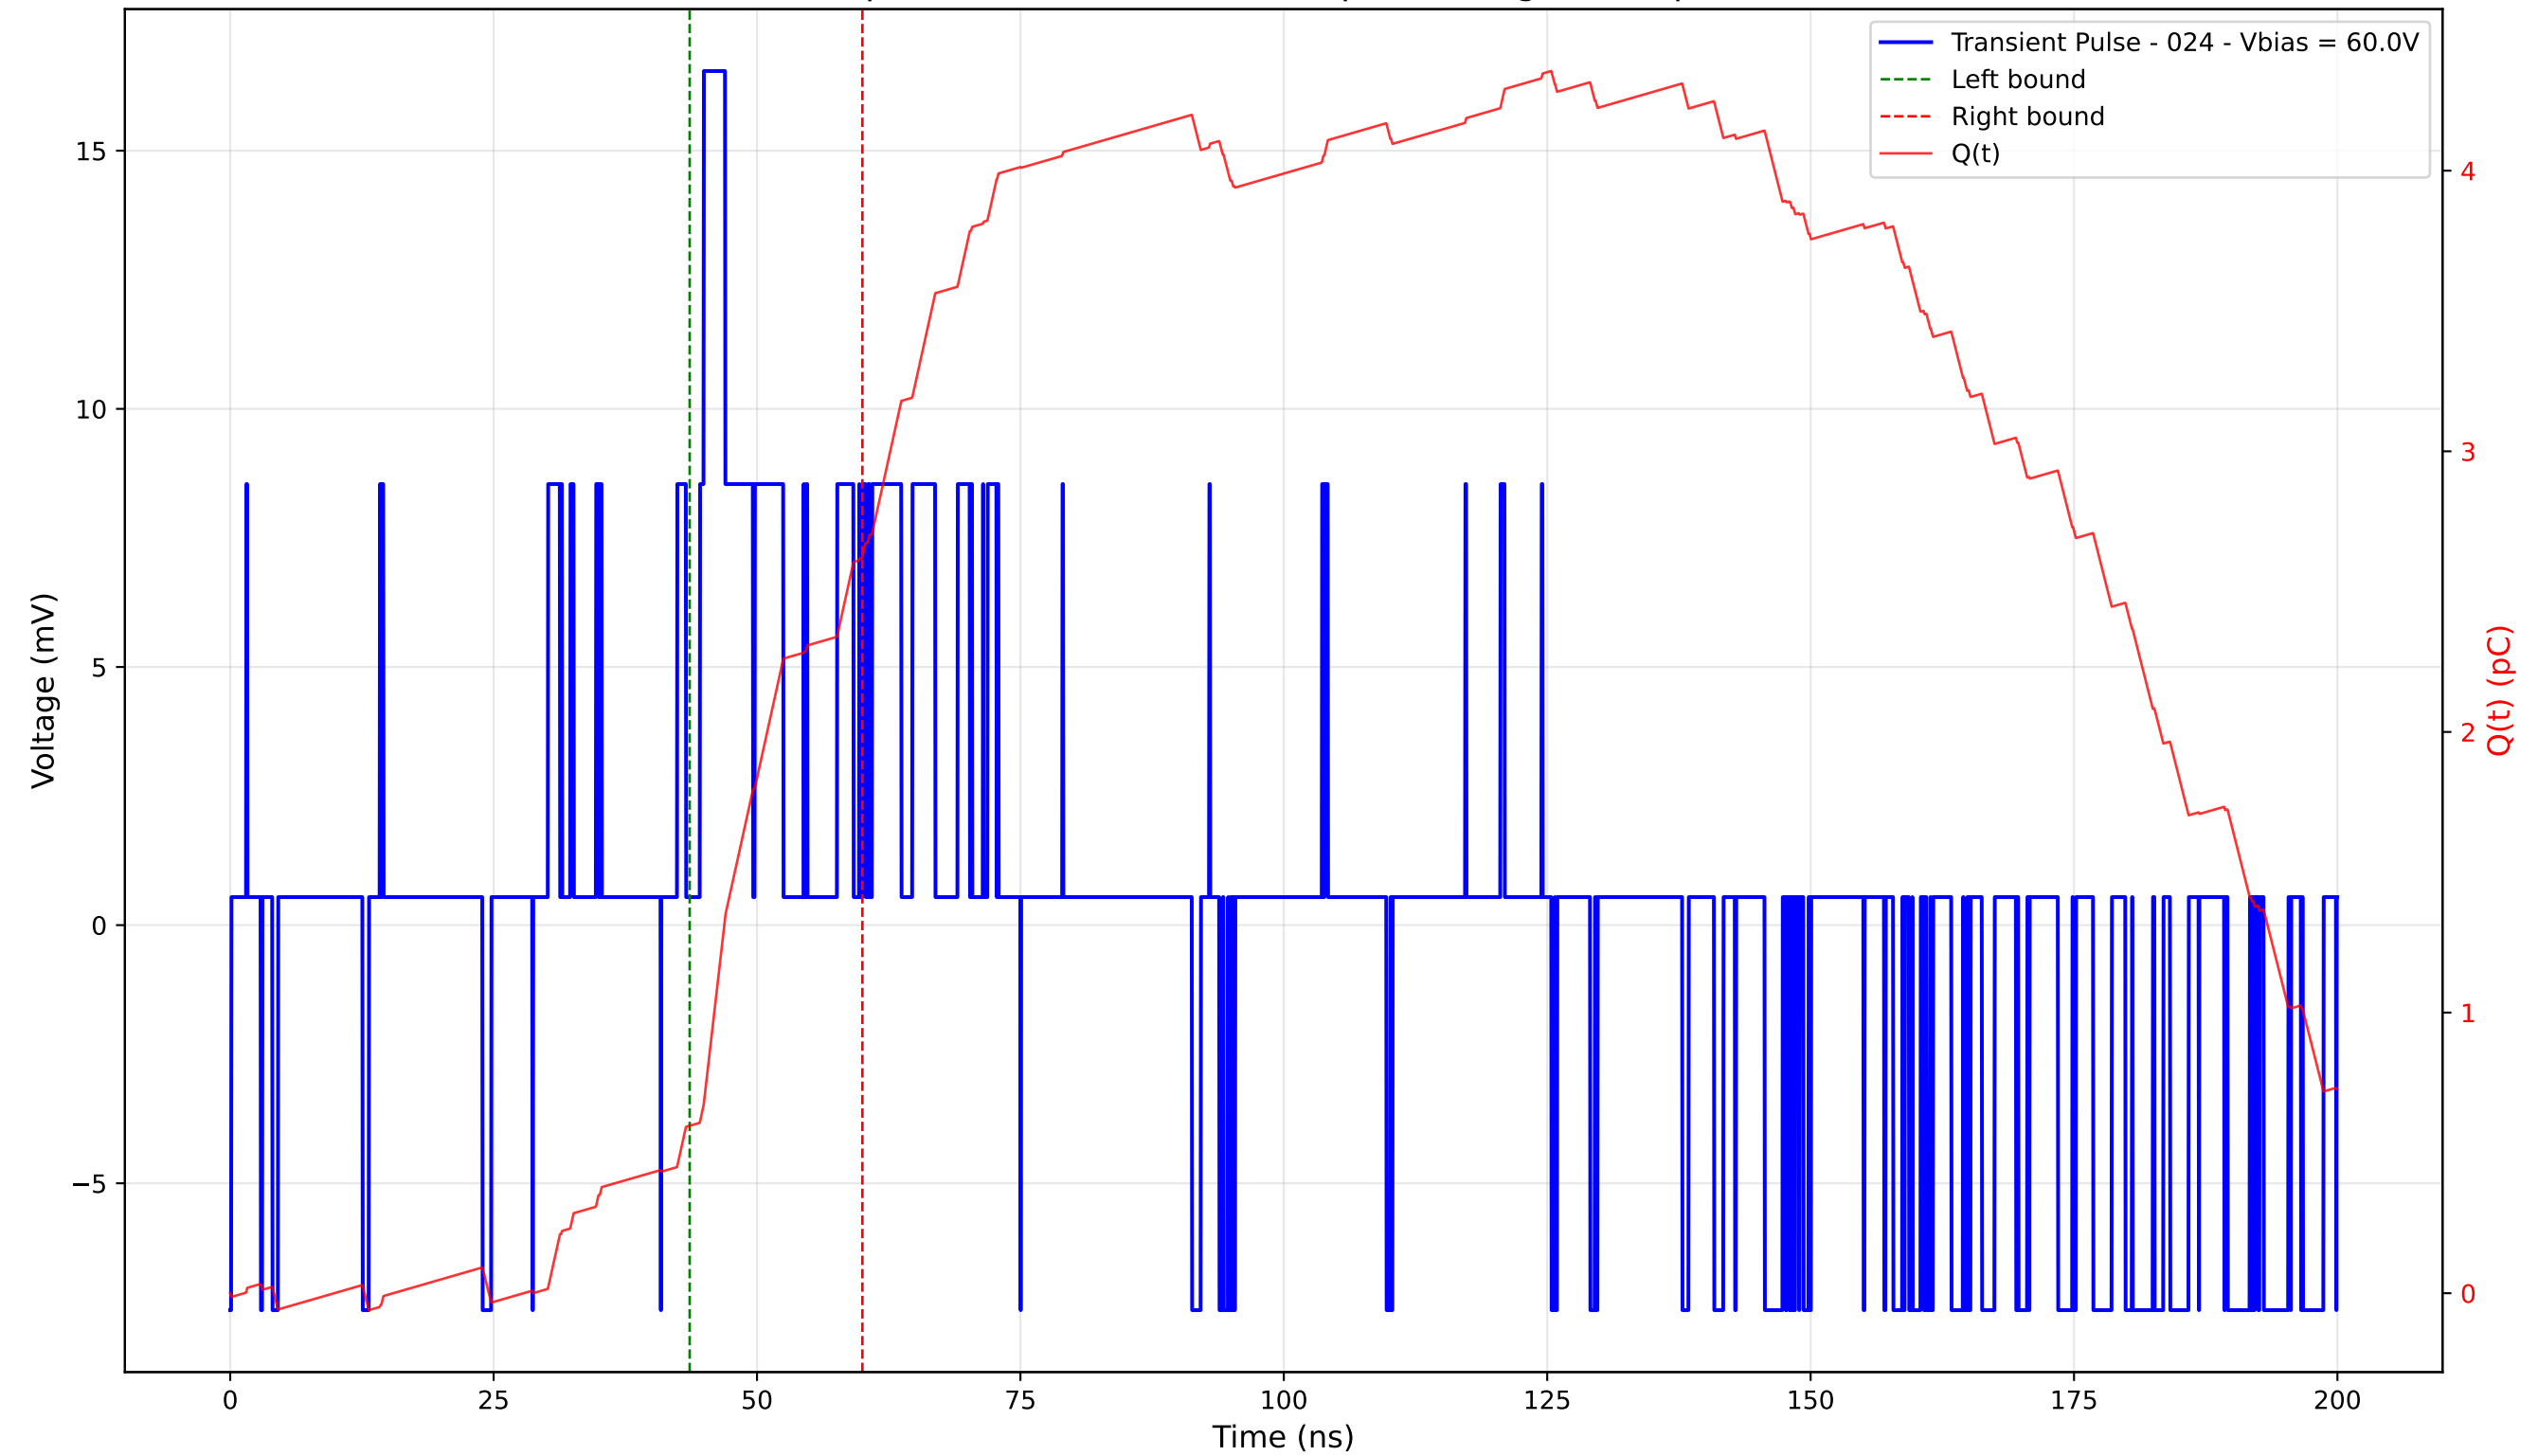


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 2.27 pC - Rise Time: 0.70 ns

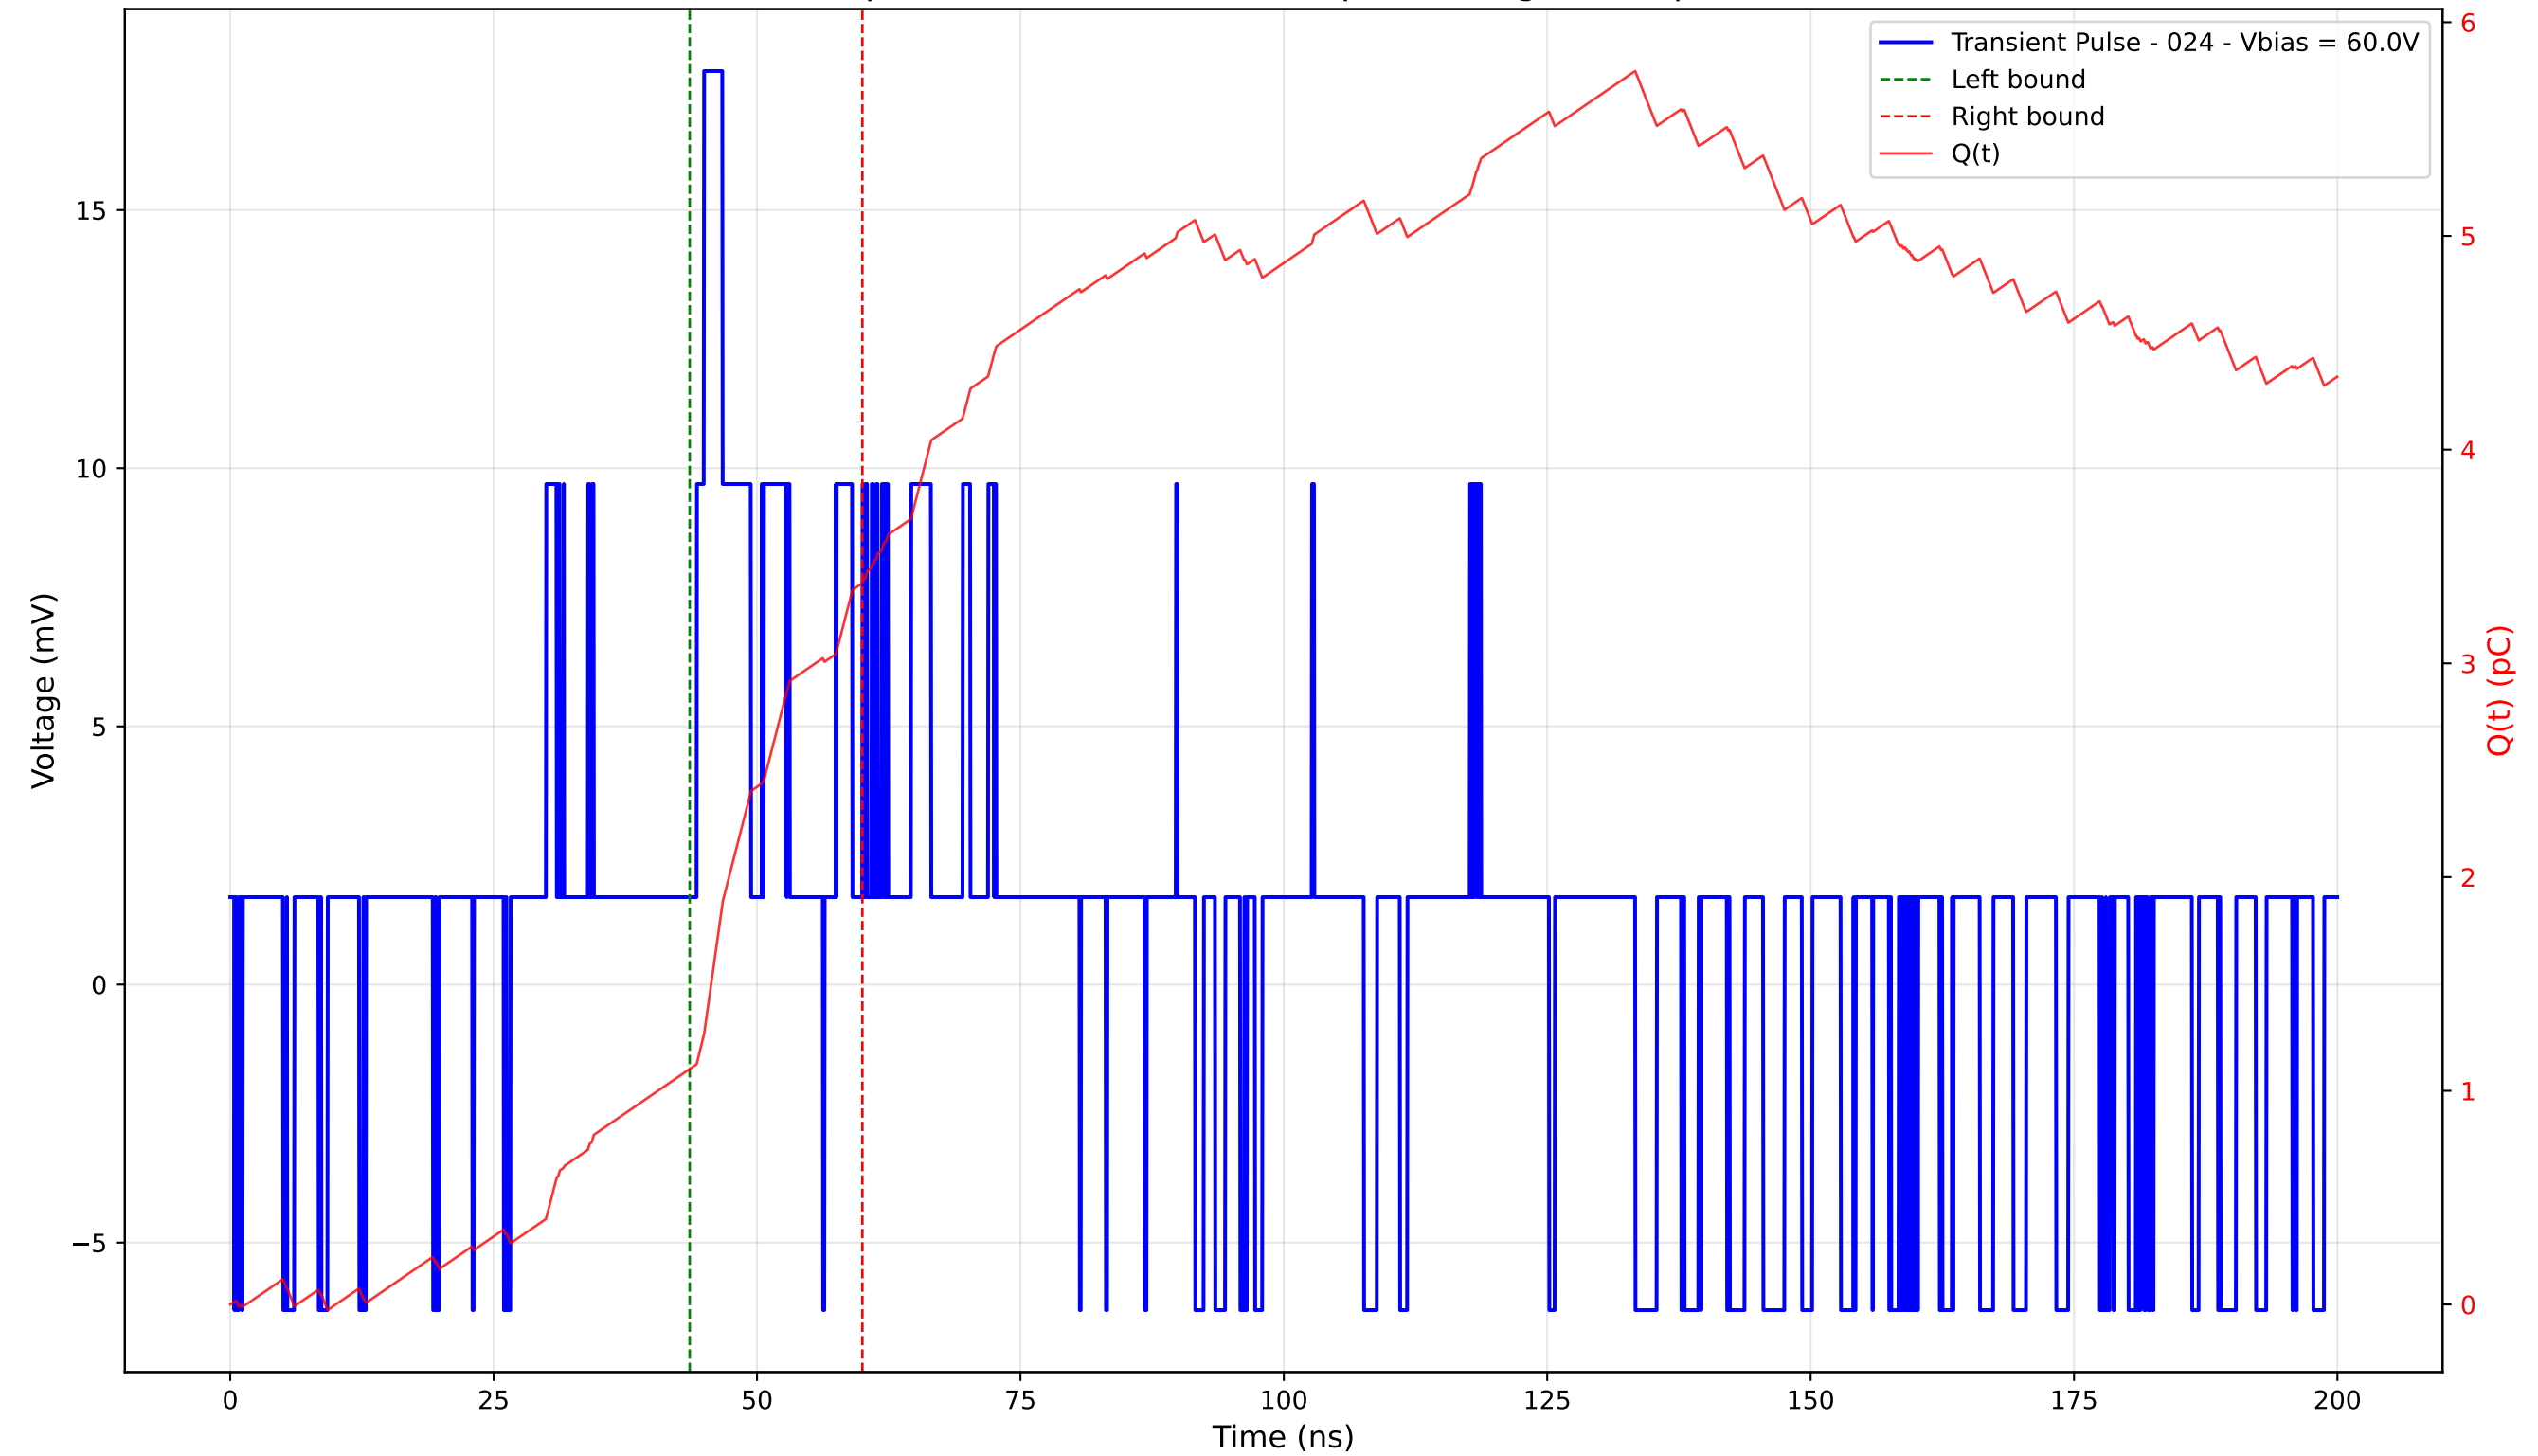


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 2.15 pC - Rise Time: 1.24 ns

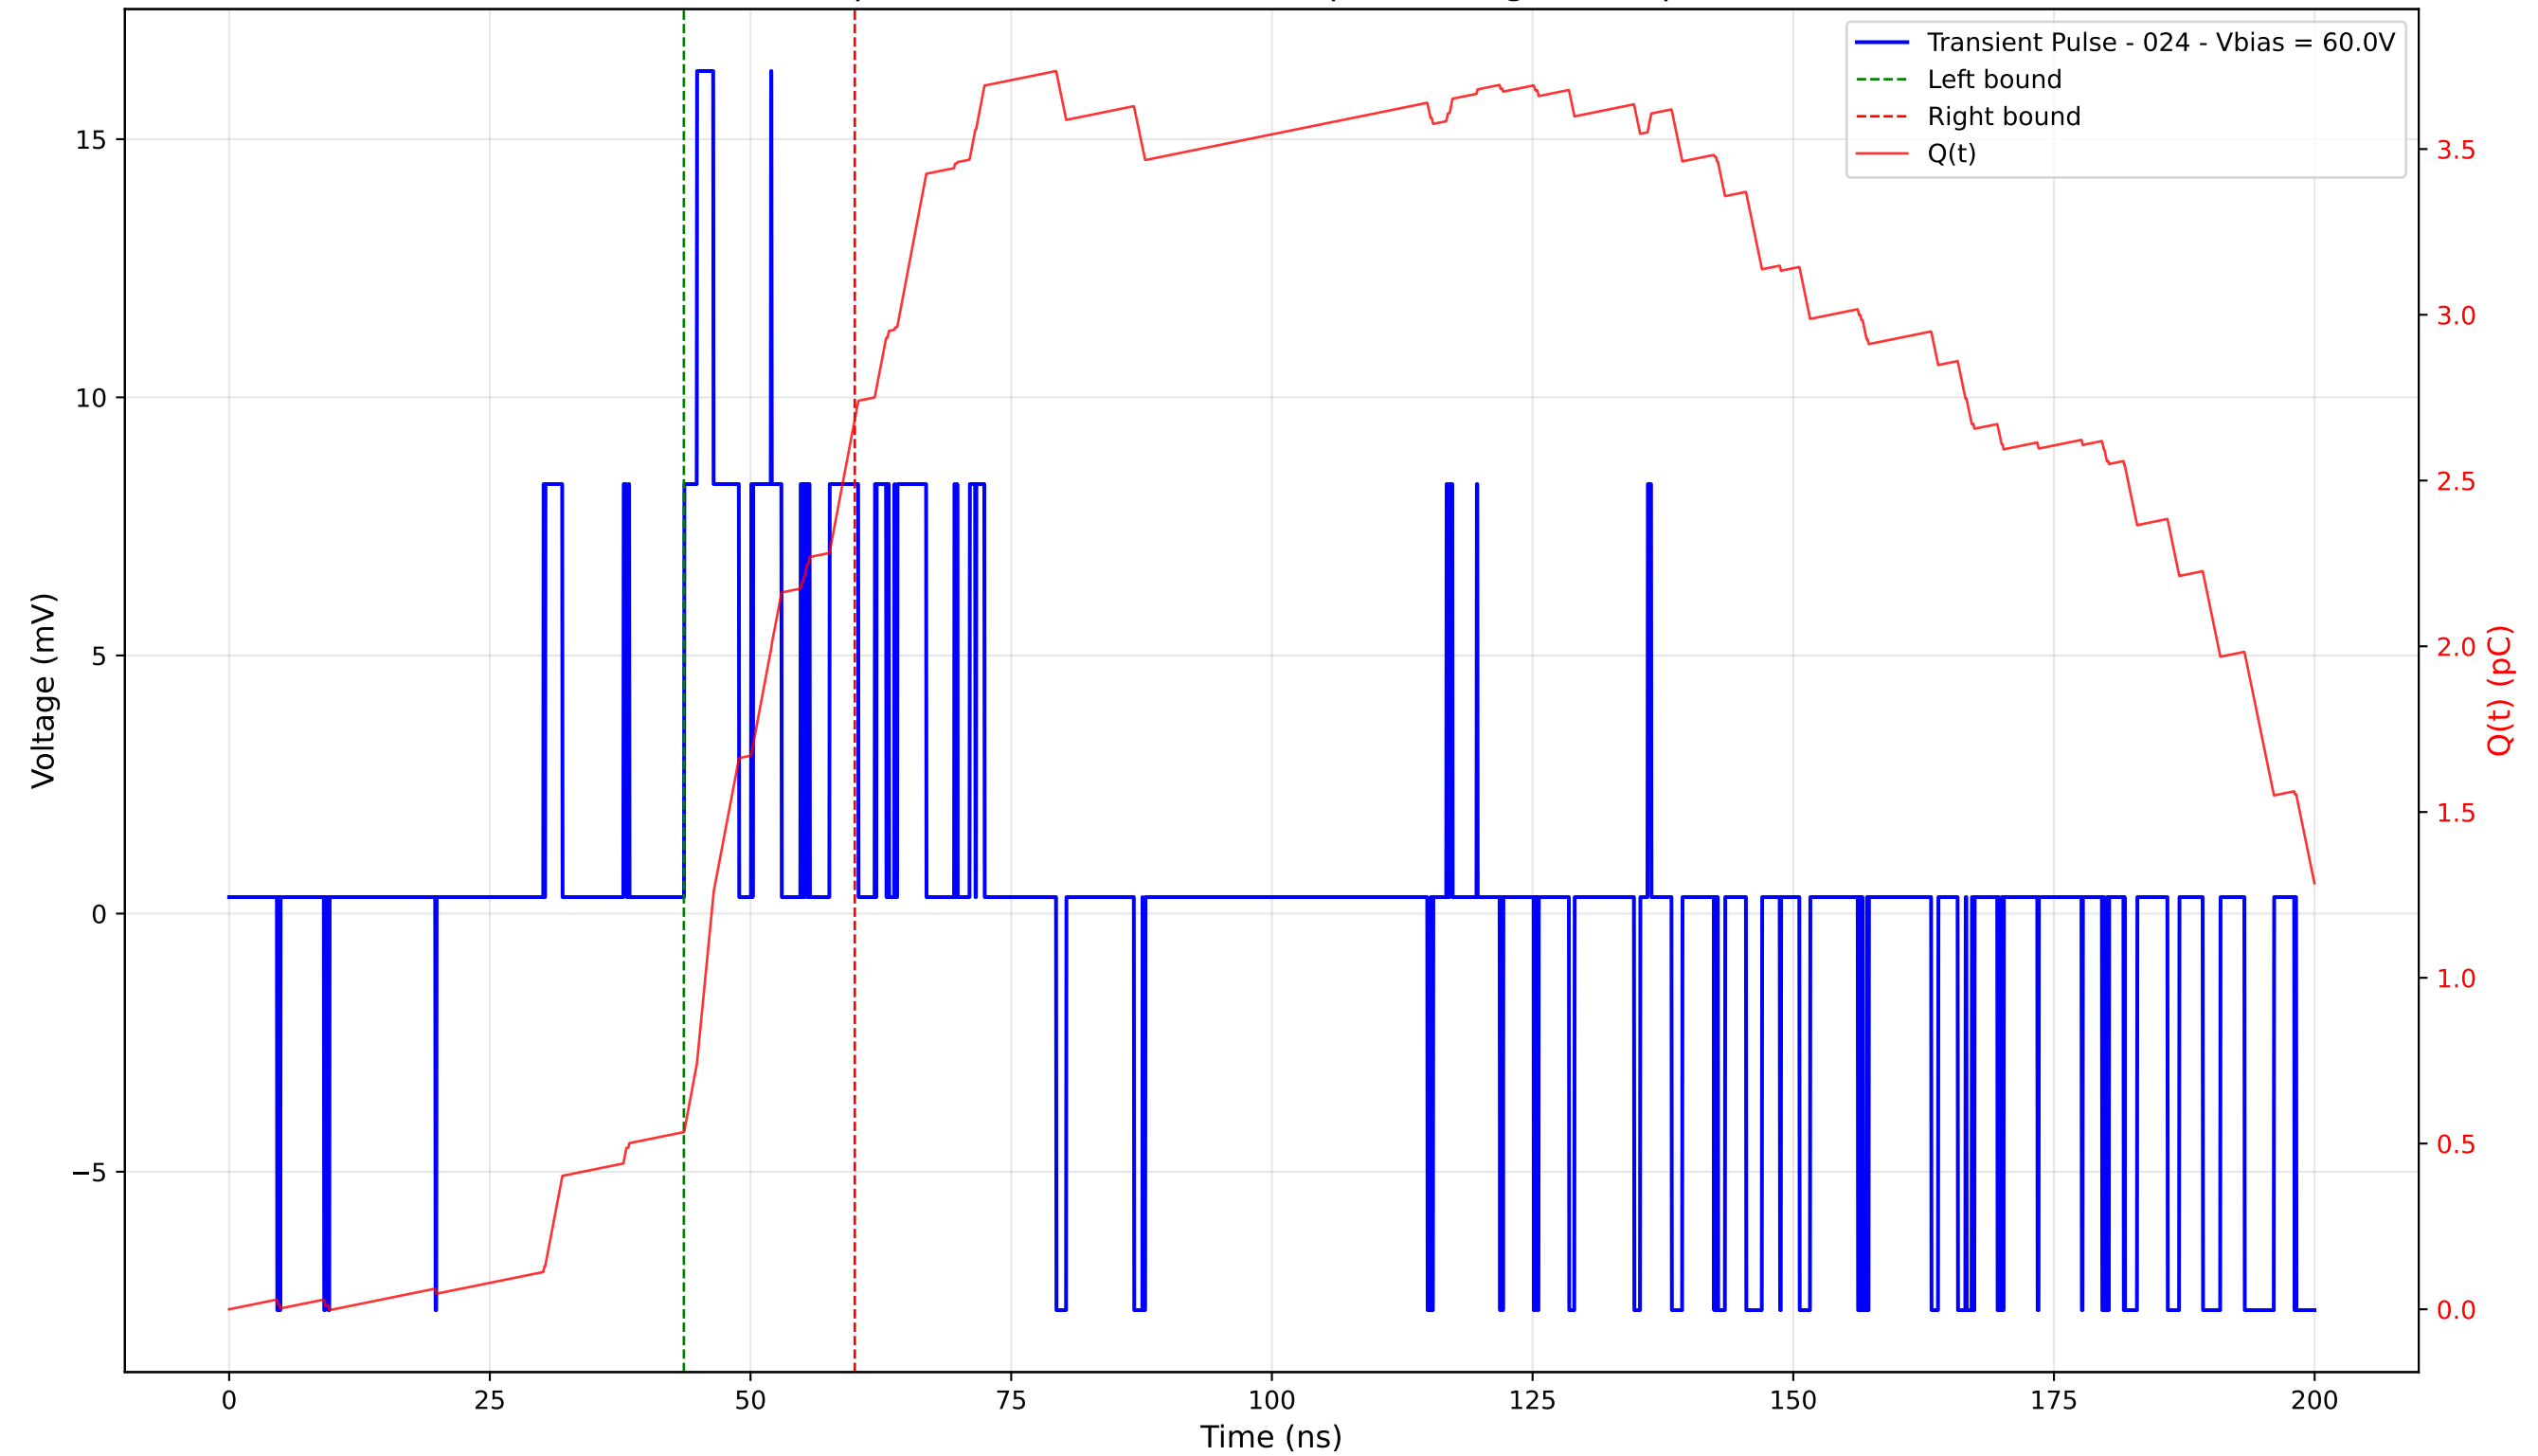


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 2.48 pC - Rise Time: 1.06 ns

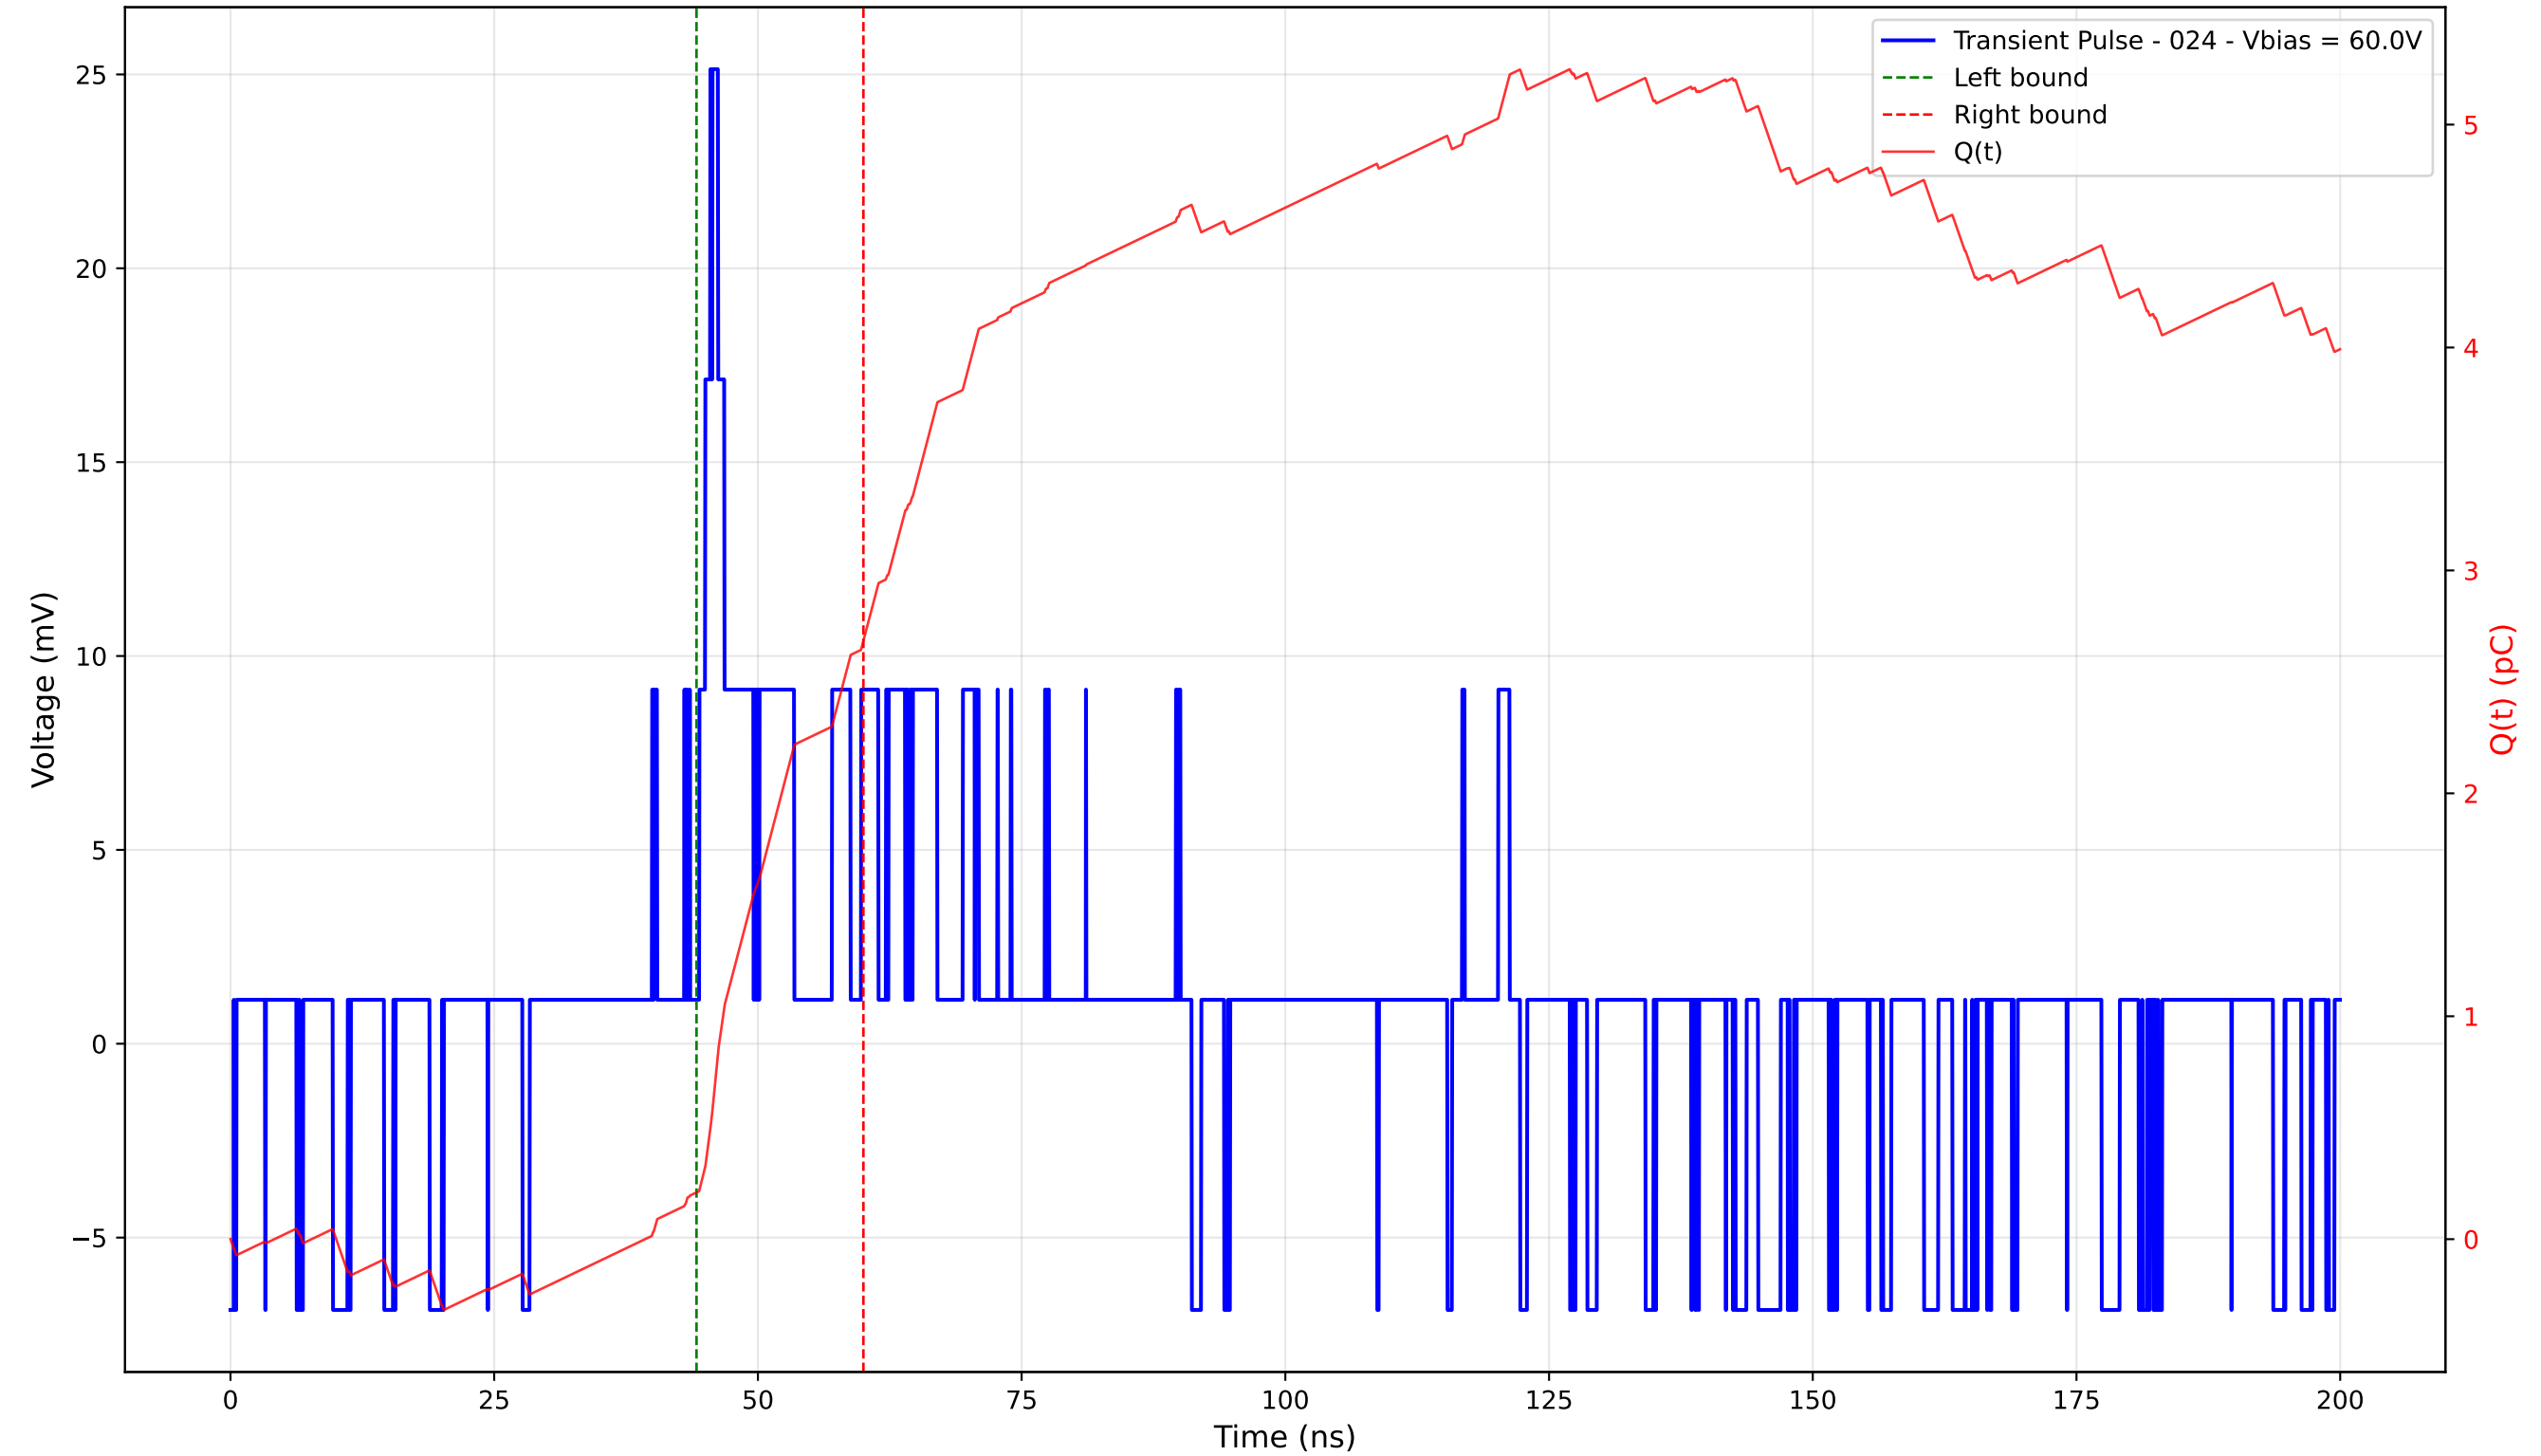


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.84 pC - Rise Time: 0.00 ns (N/A)

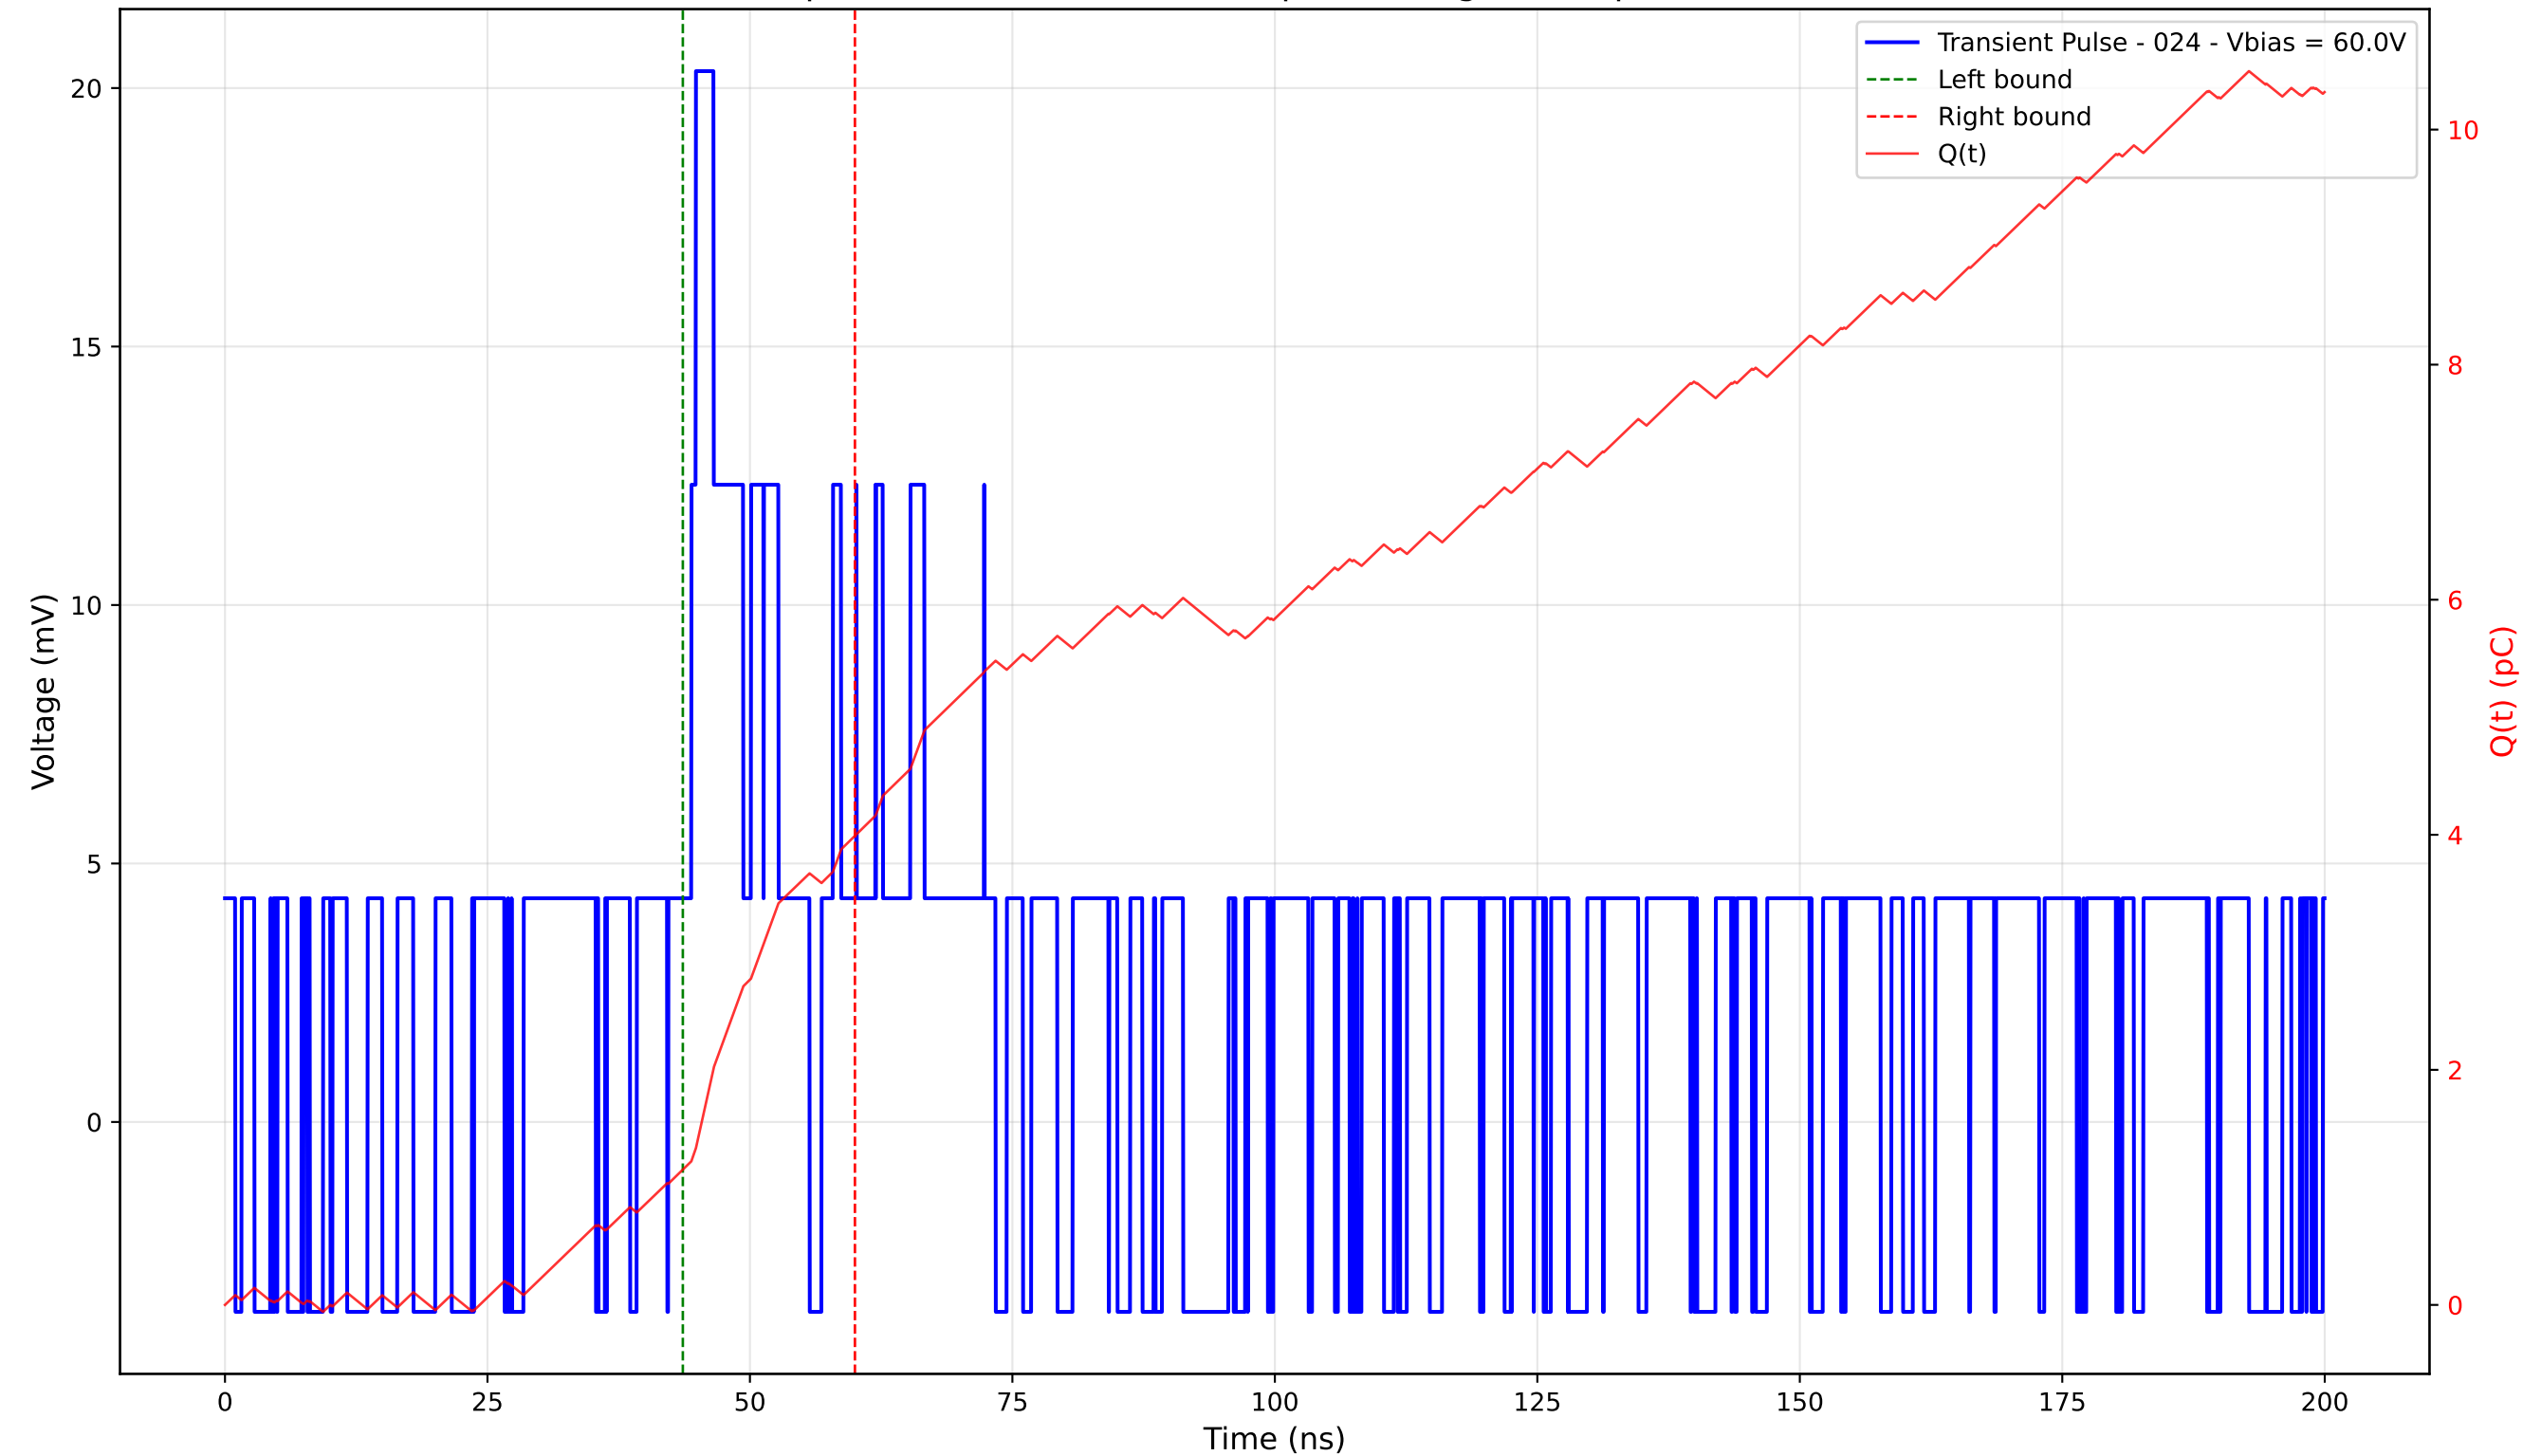


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 1.77 pC - Rise Time: 0.00 ns (N/A)

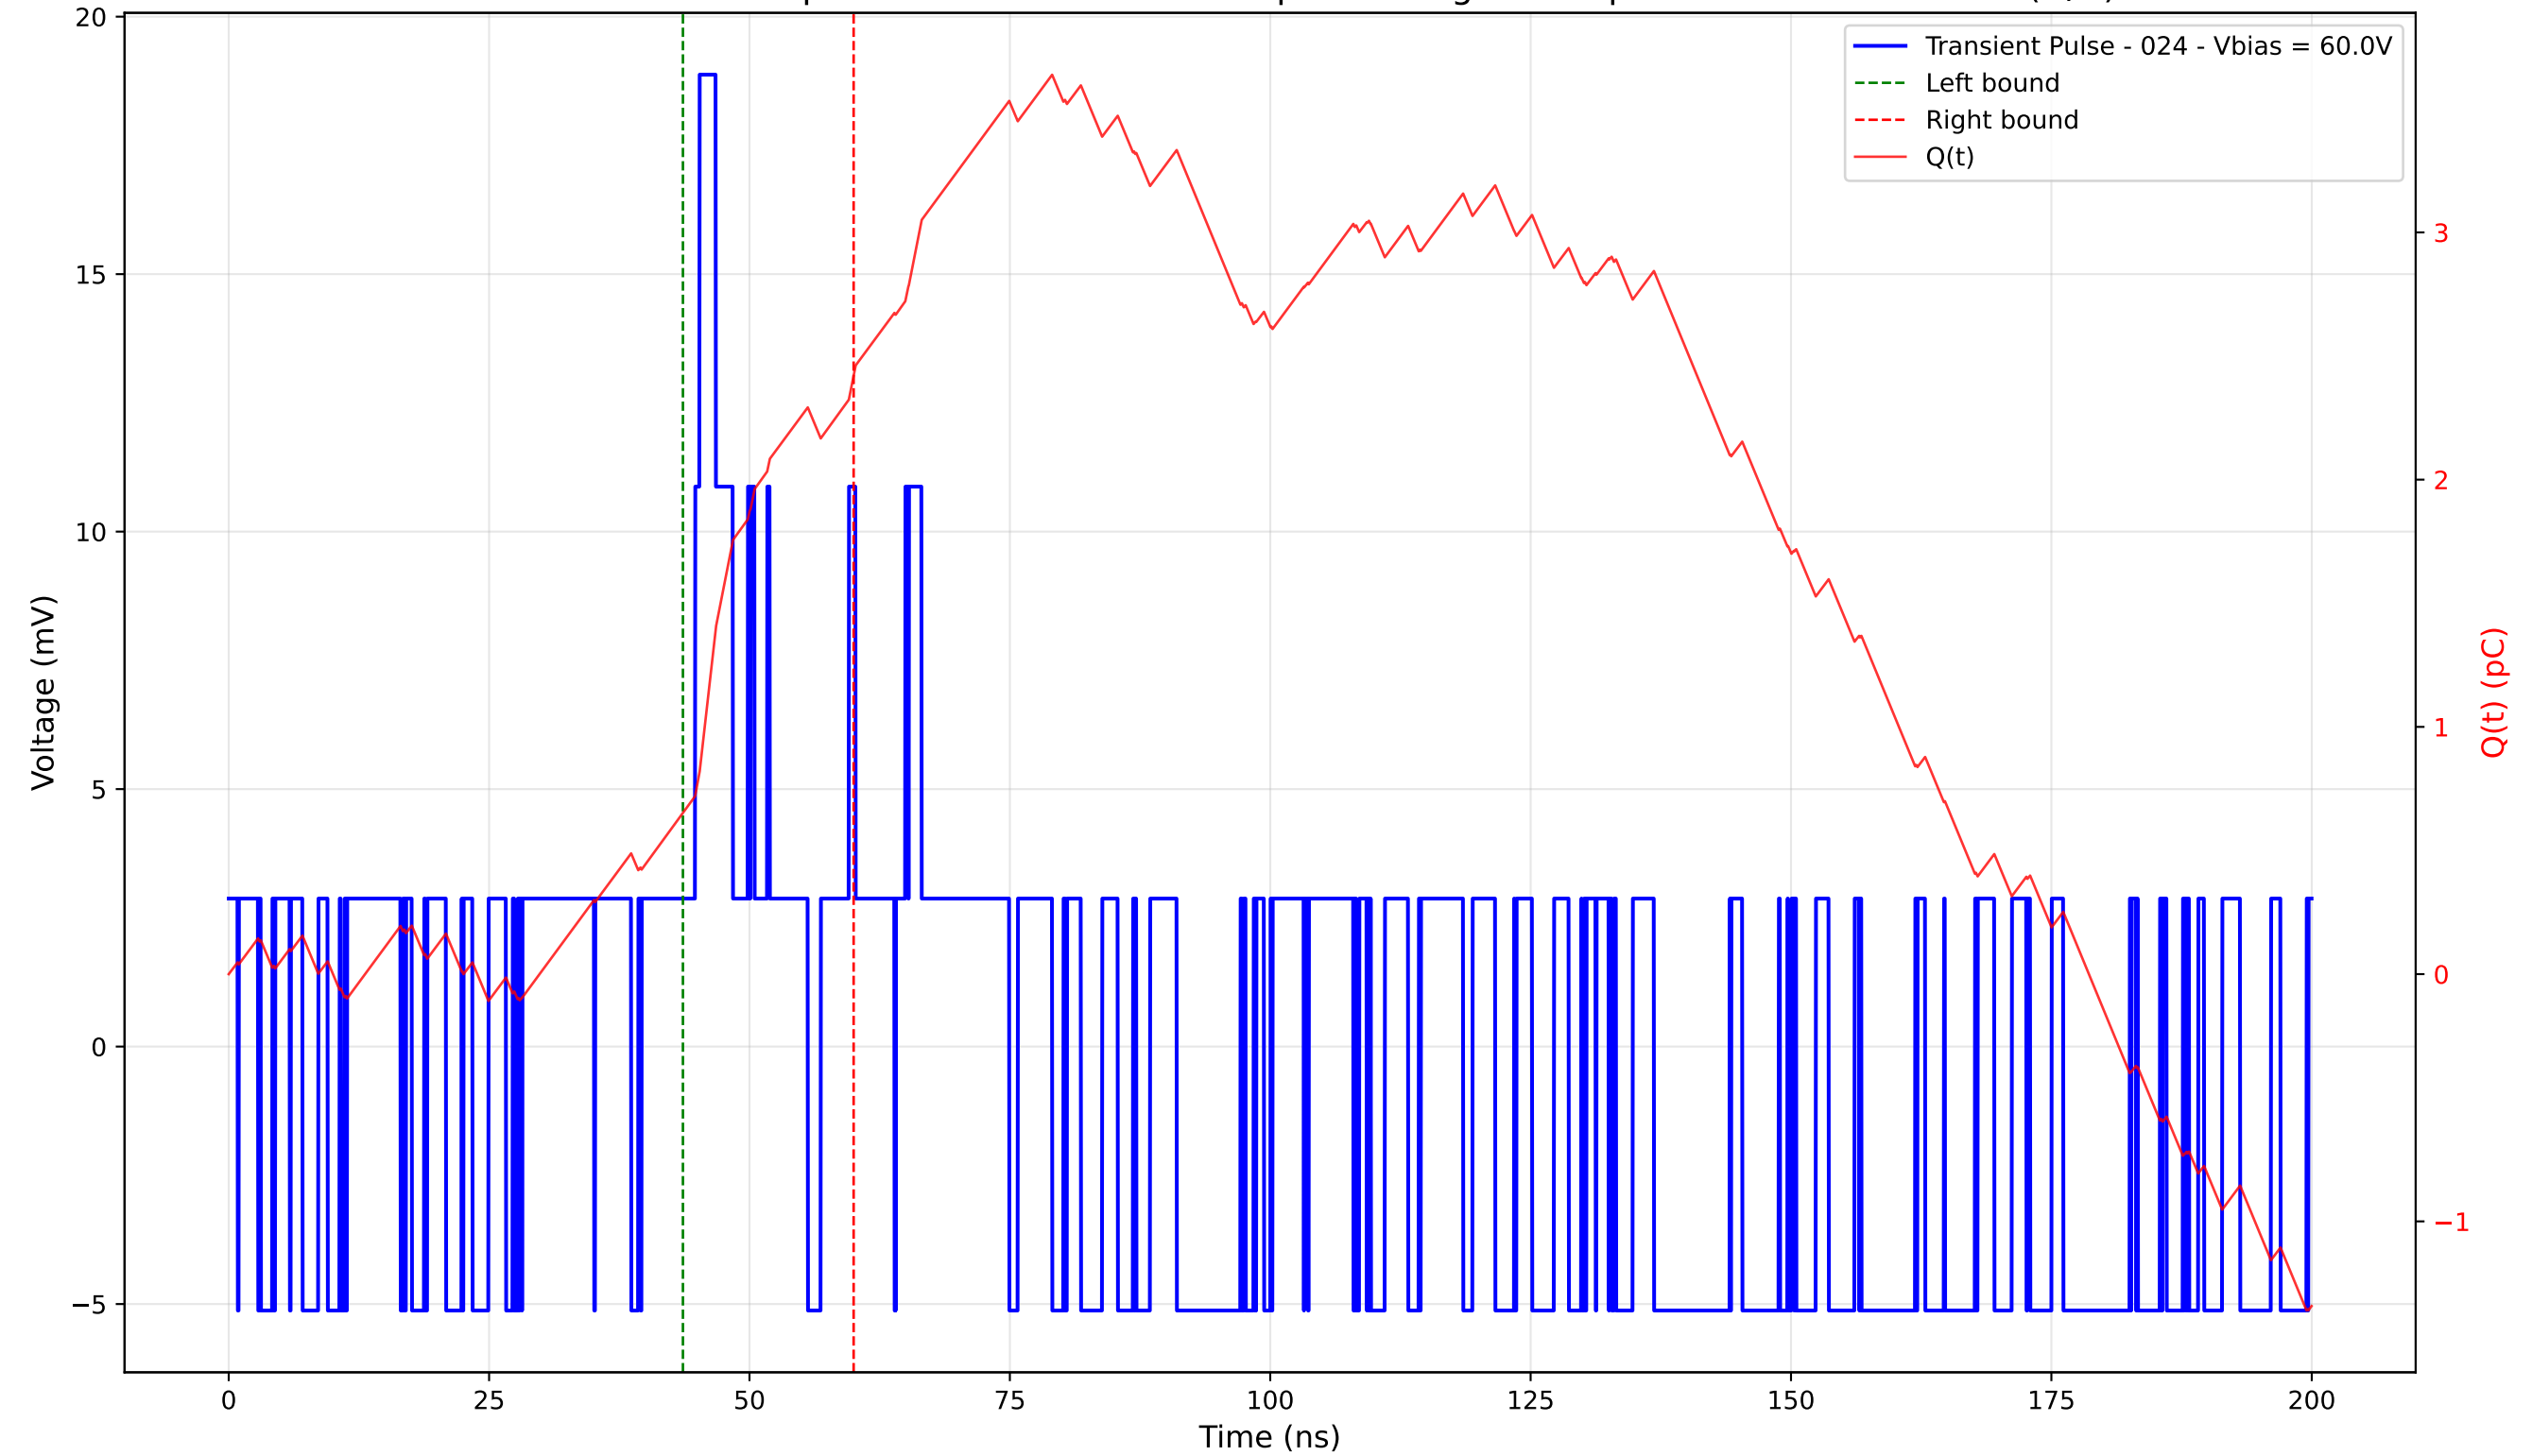


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 2.69 pC - Rise Time: 1.14 ns

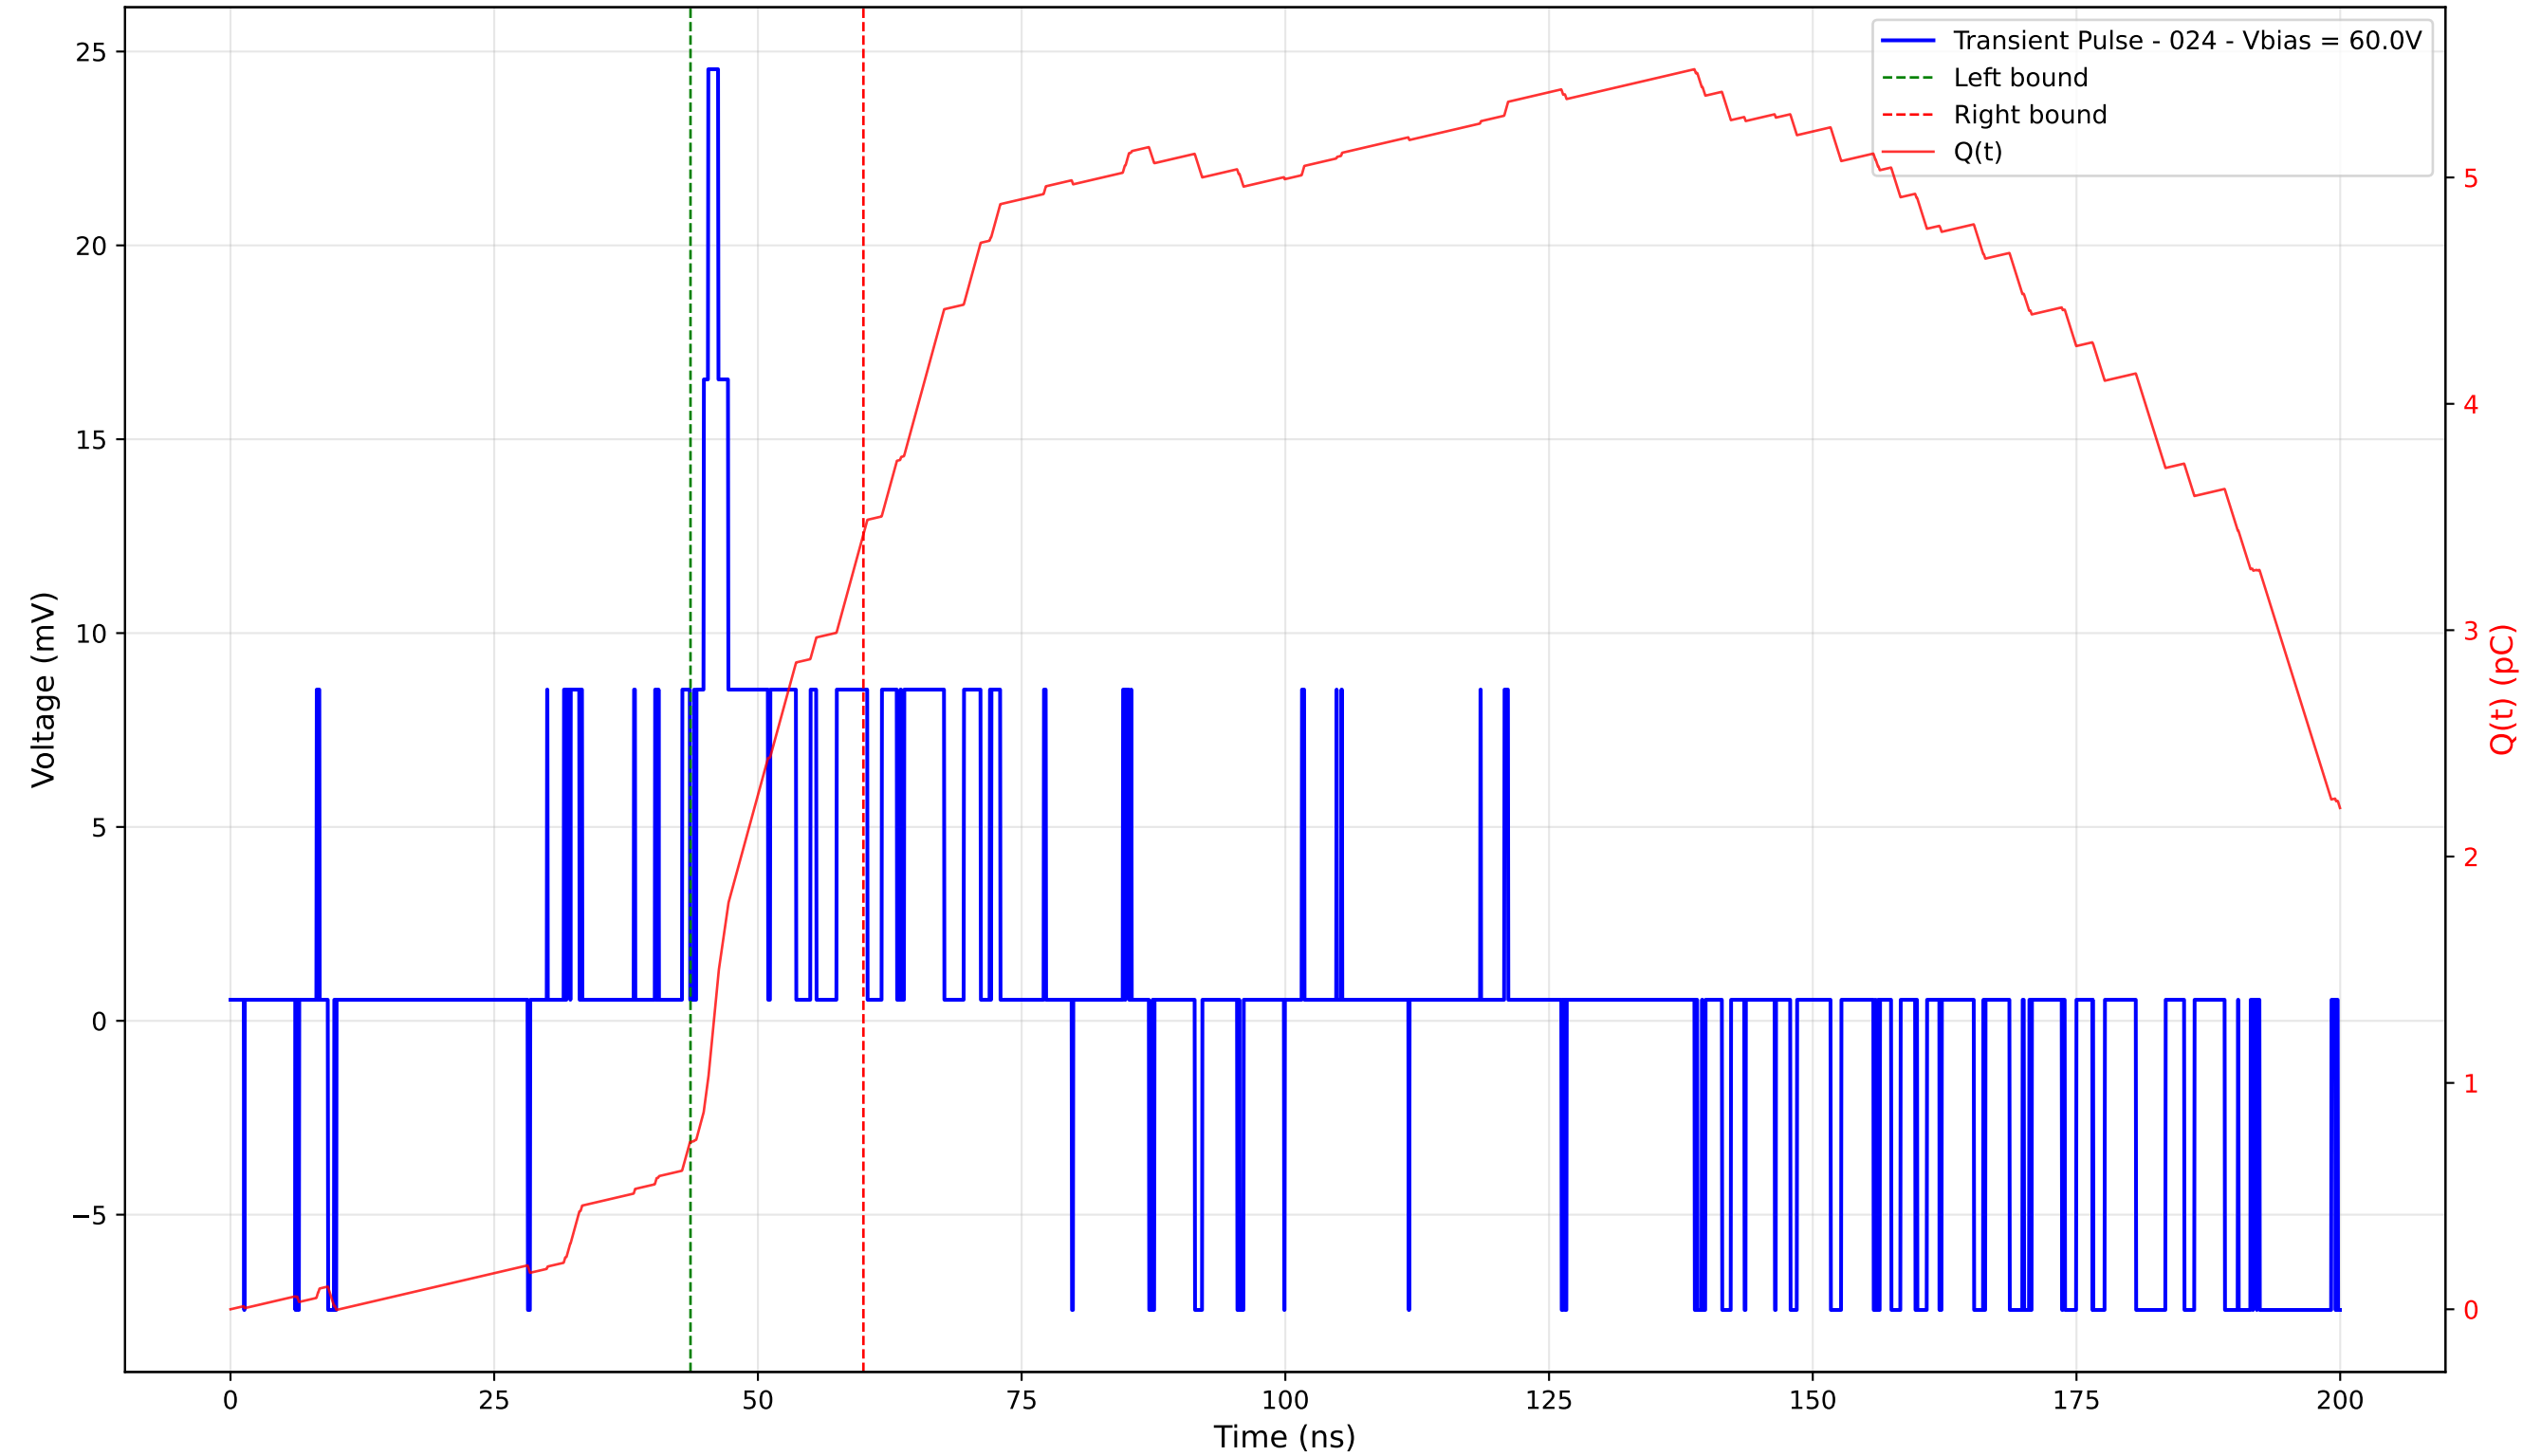


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 2.42 pC - Rise Time: 0.00 ns (N/A)

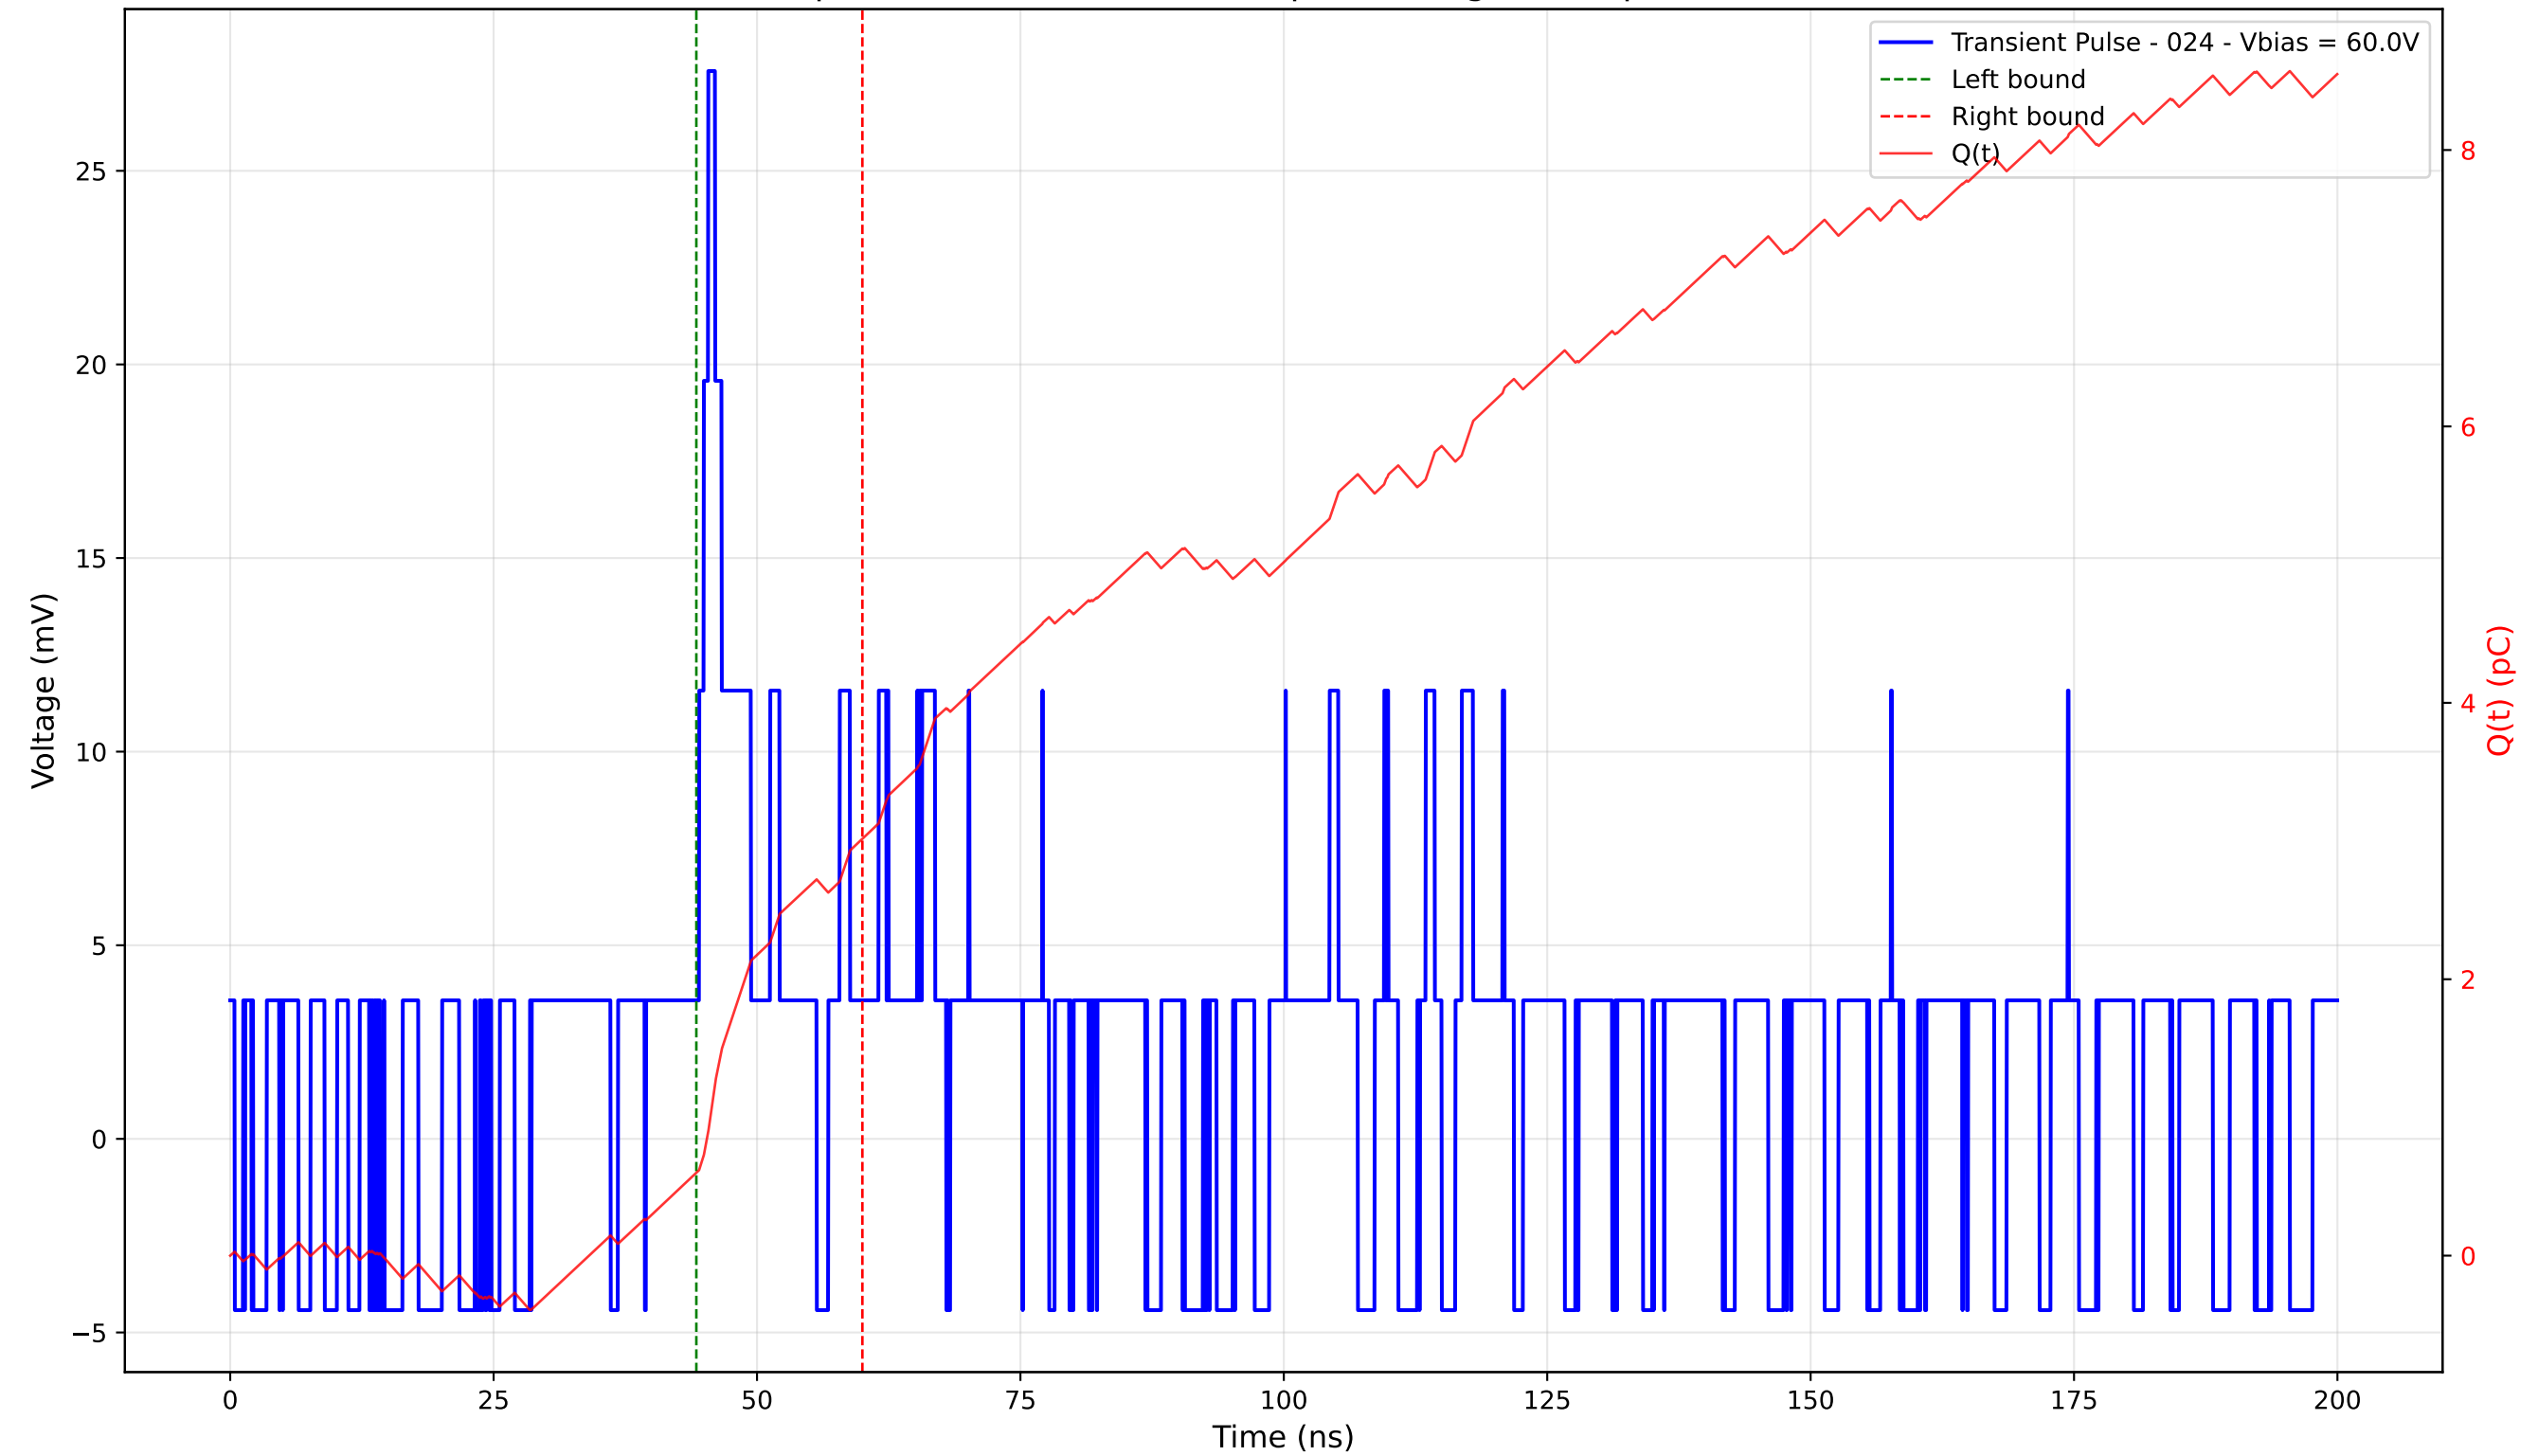


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 3.04 pC - Rise Time: 0.94 ns

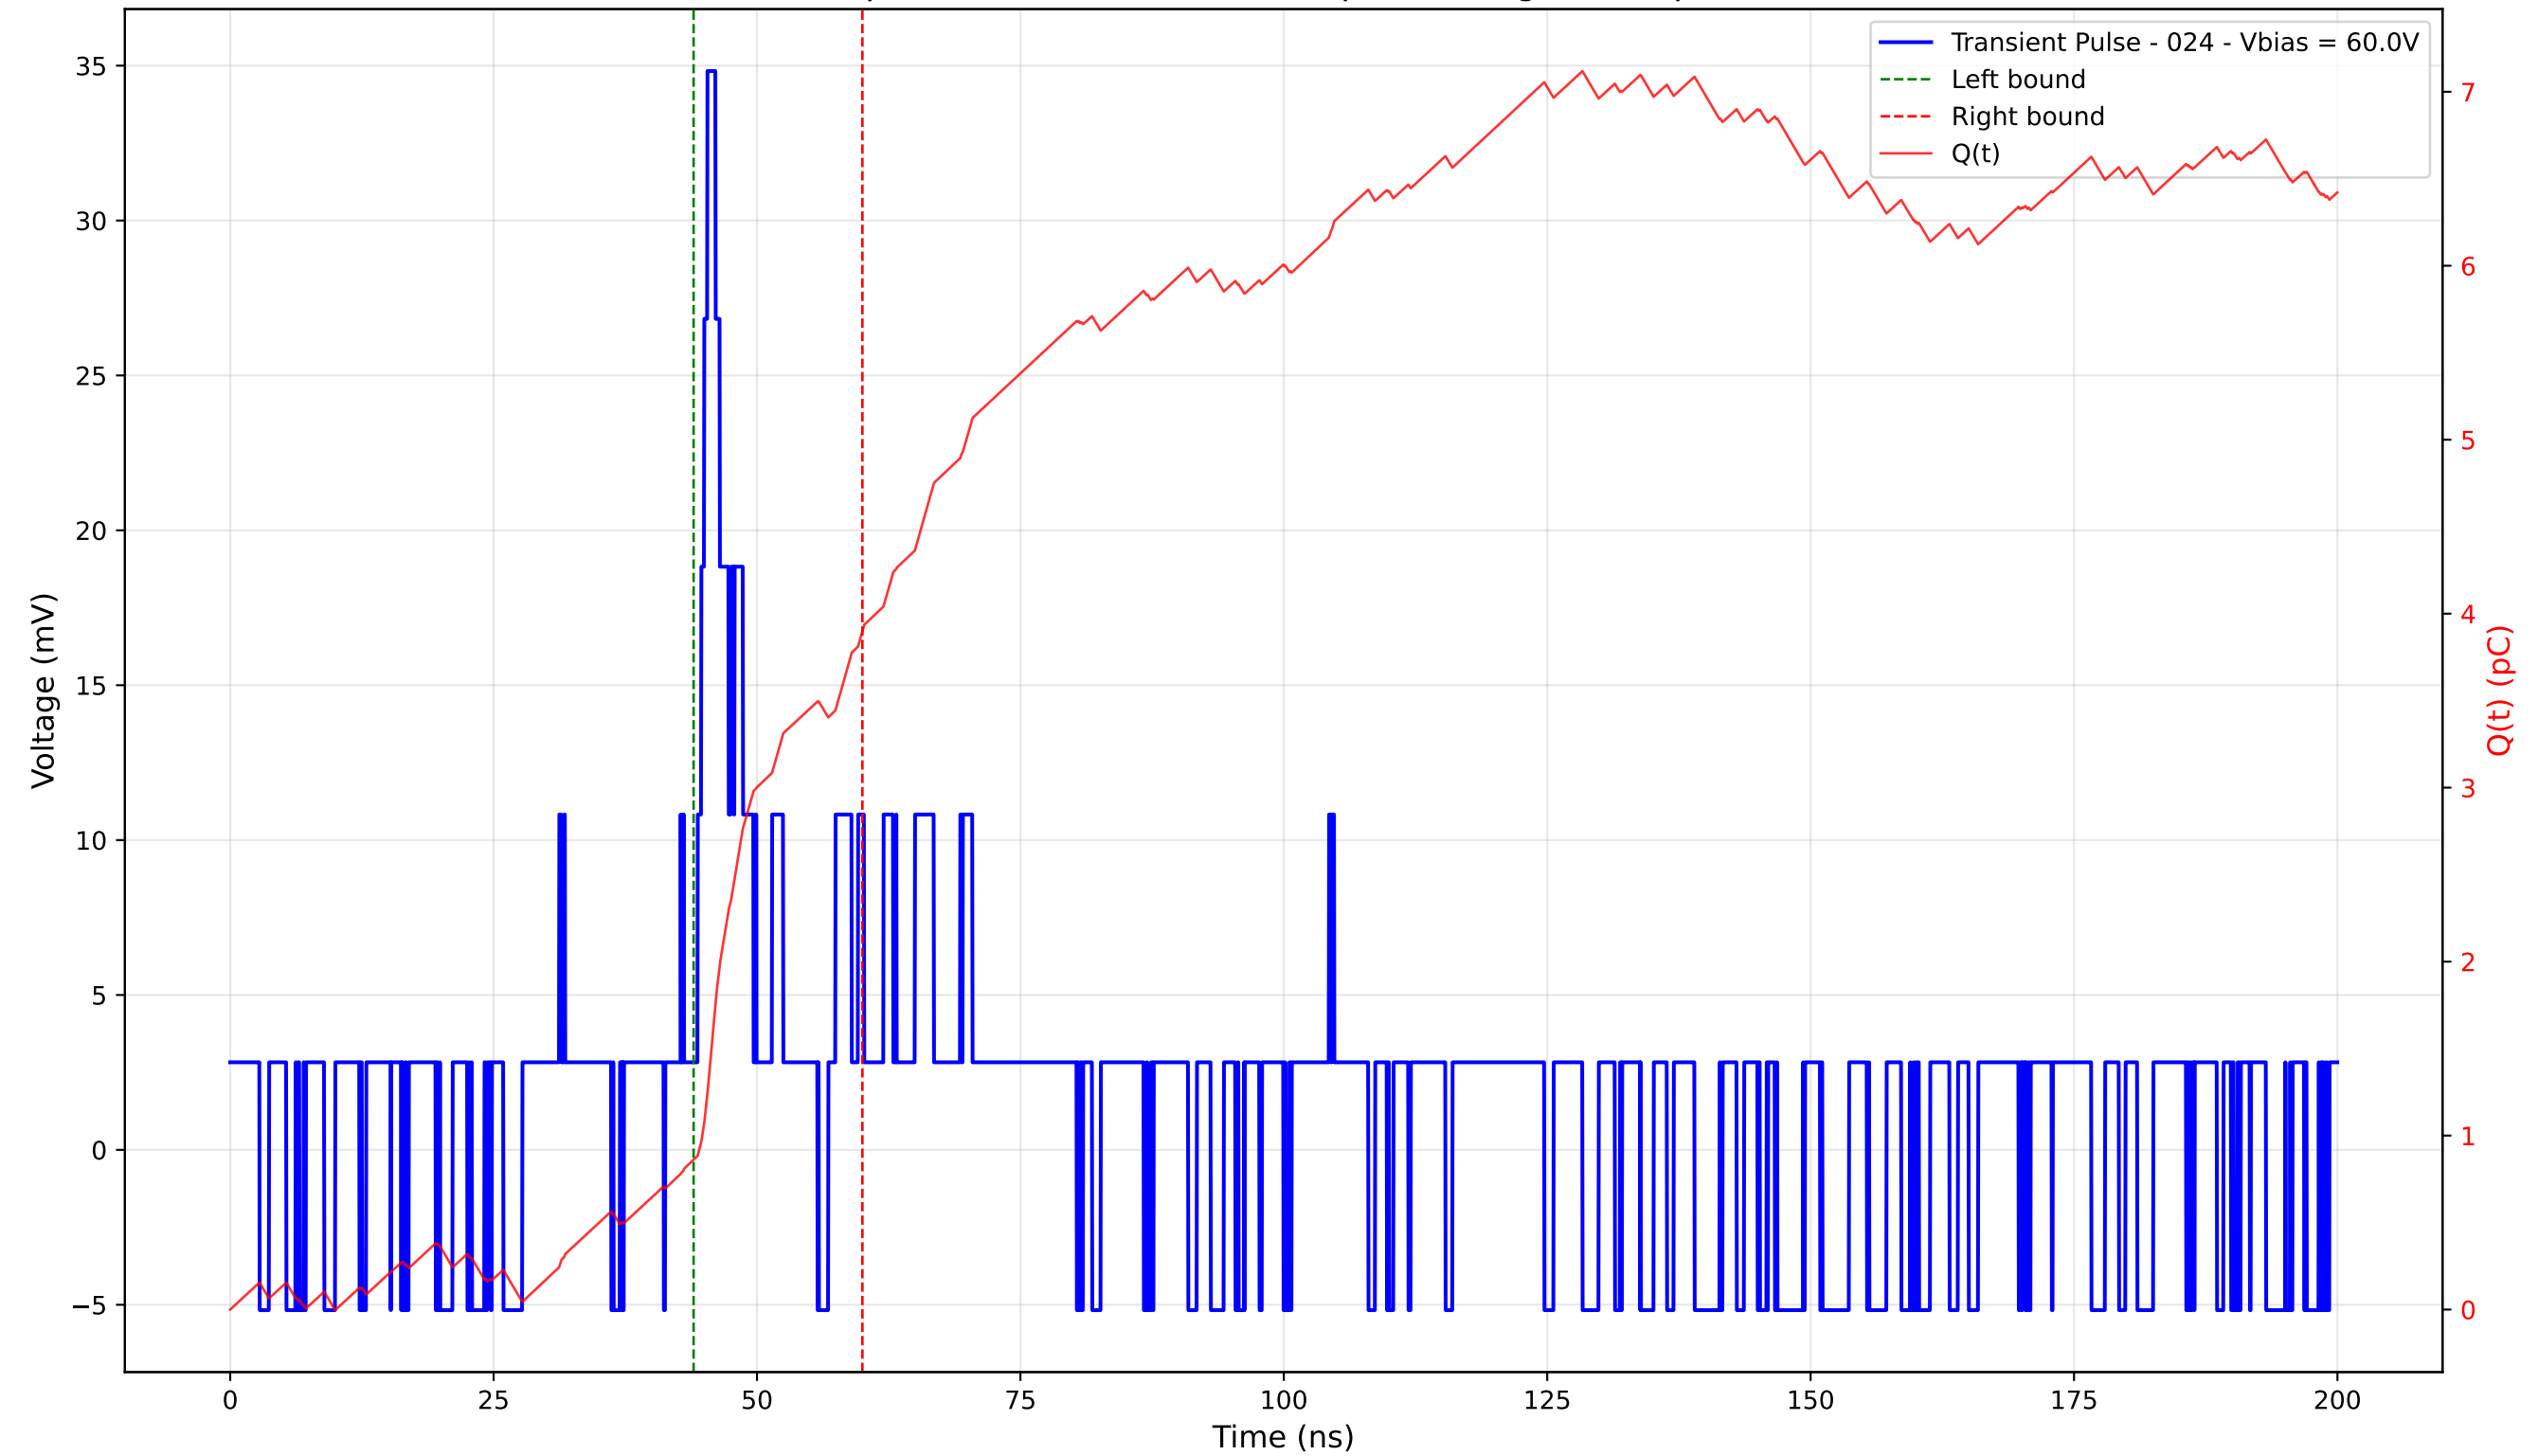


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 3.23 pC - Rise Time: 1.41 ns

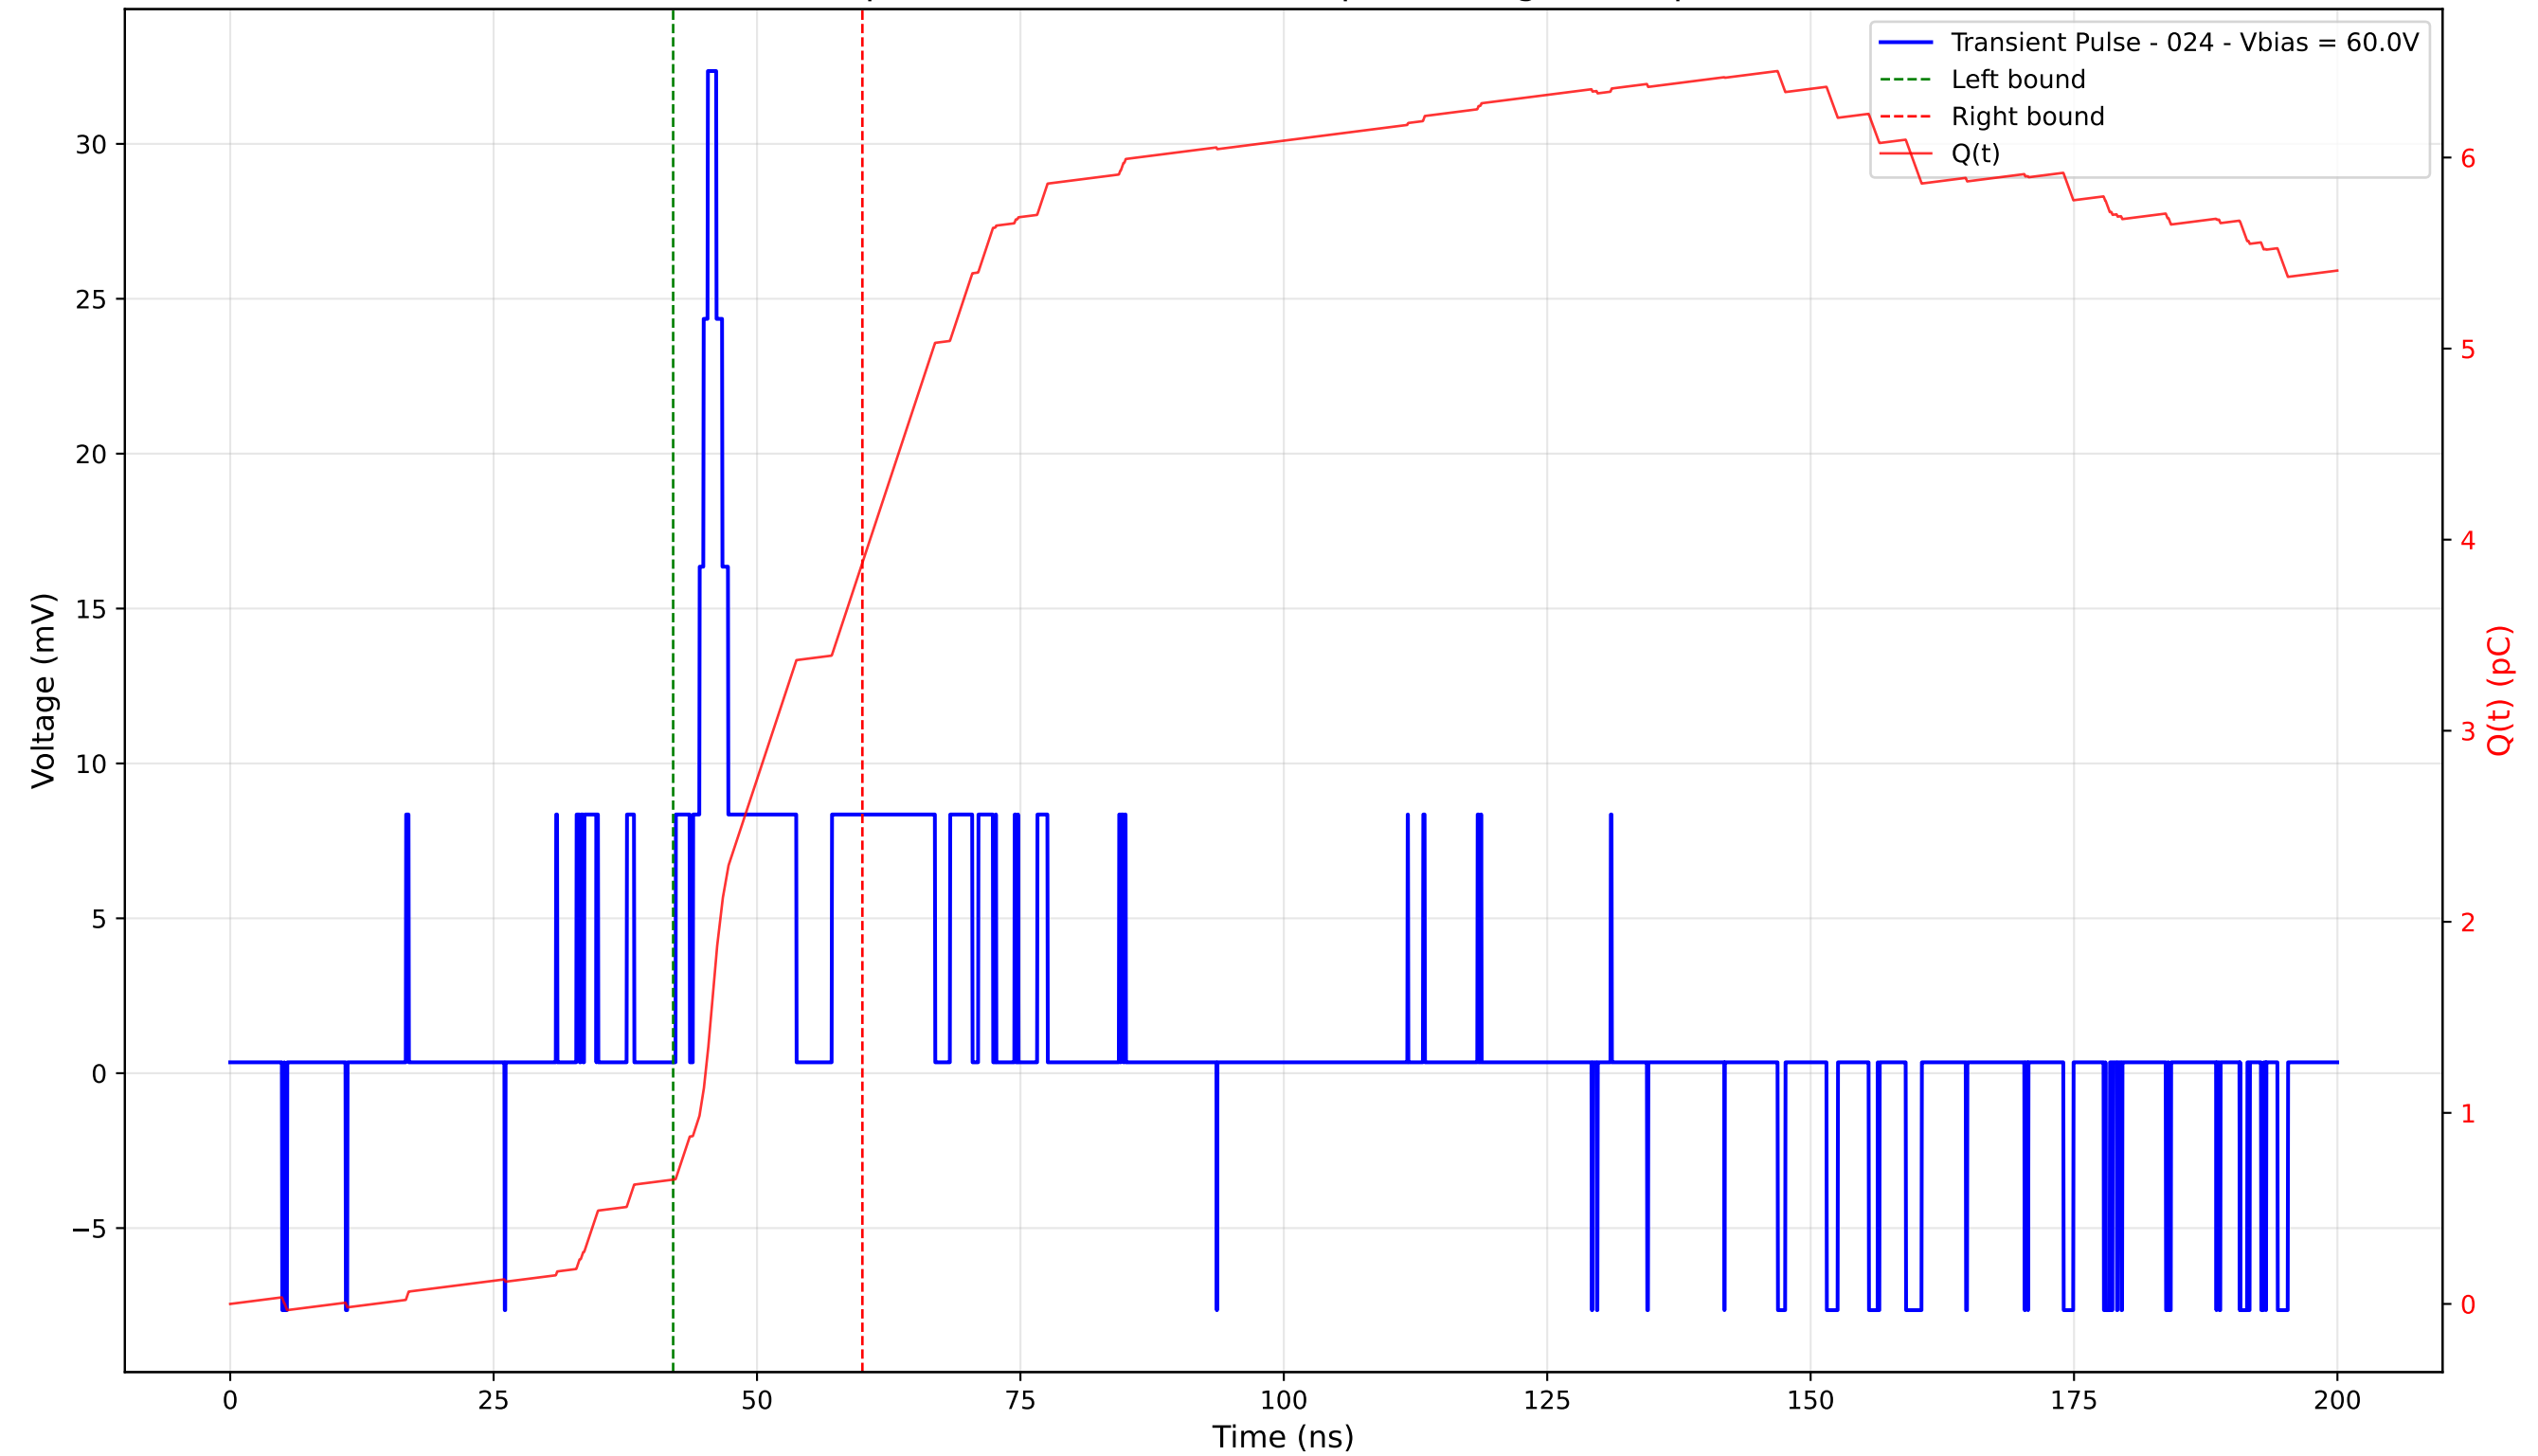


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 2.28 pC - Rise Time: 0.93 ns

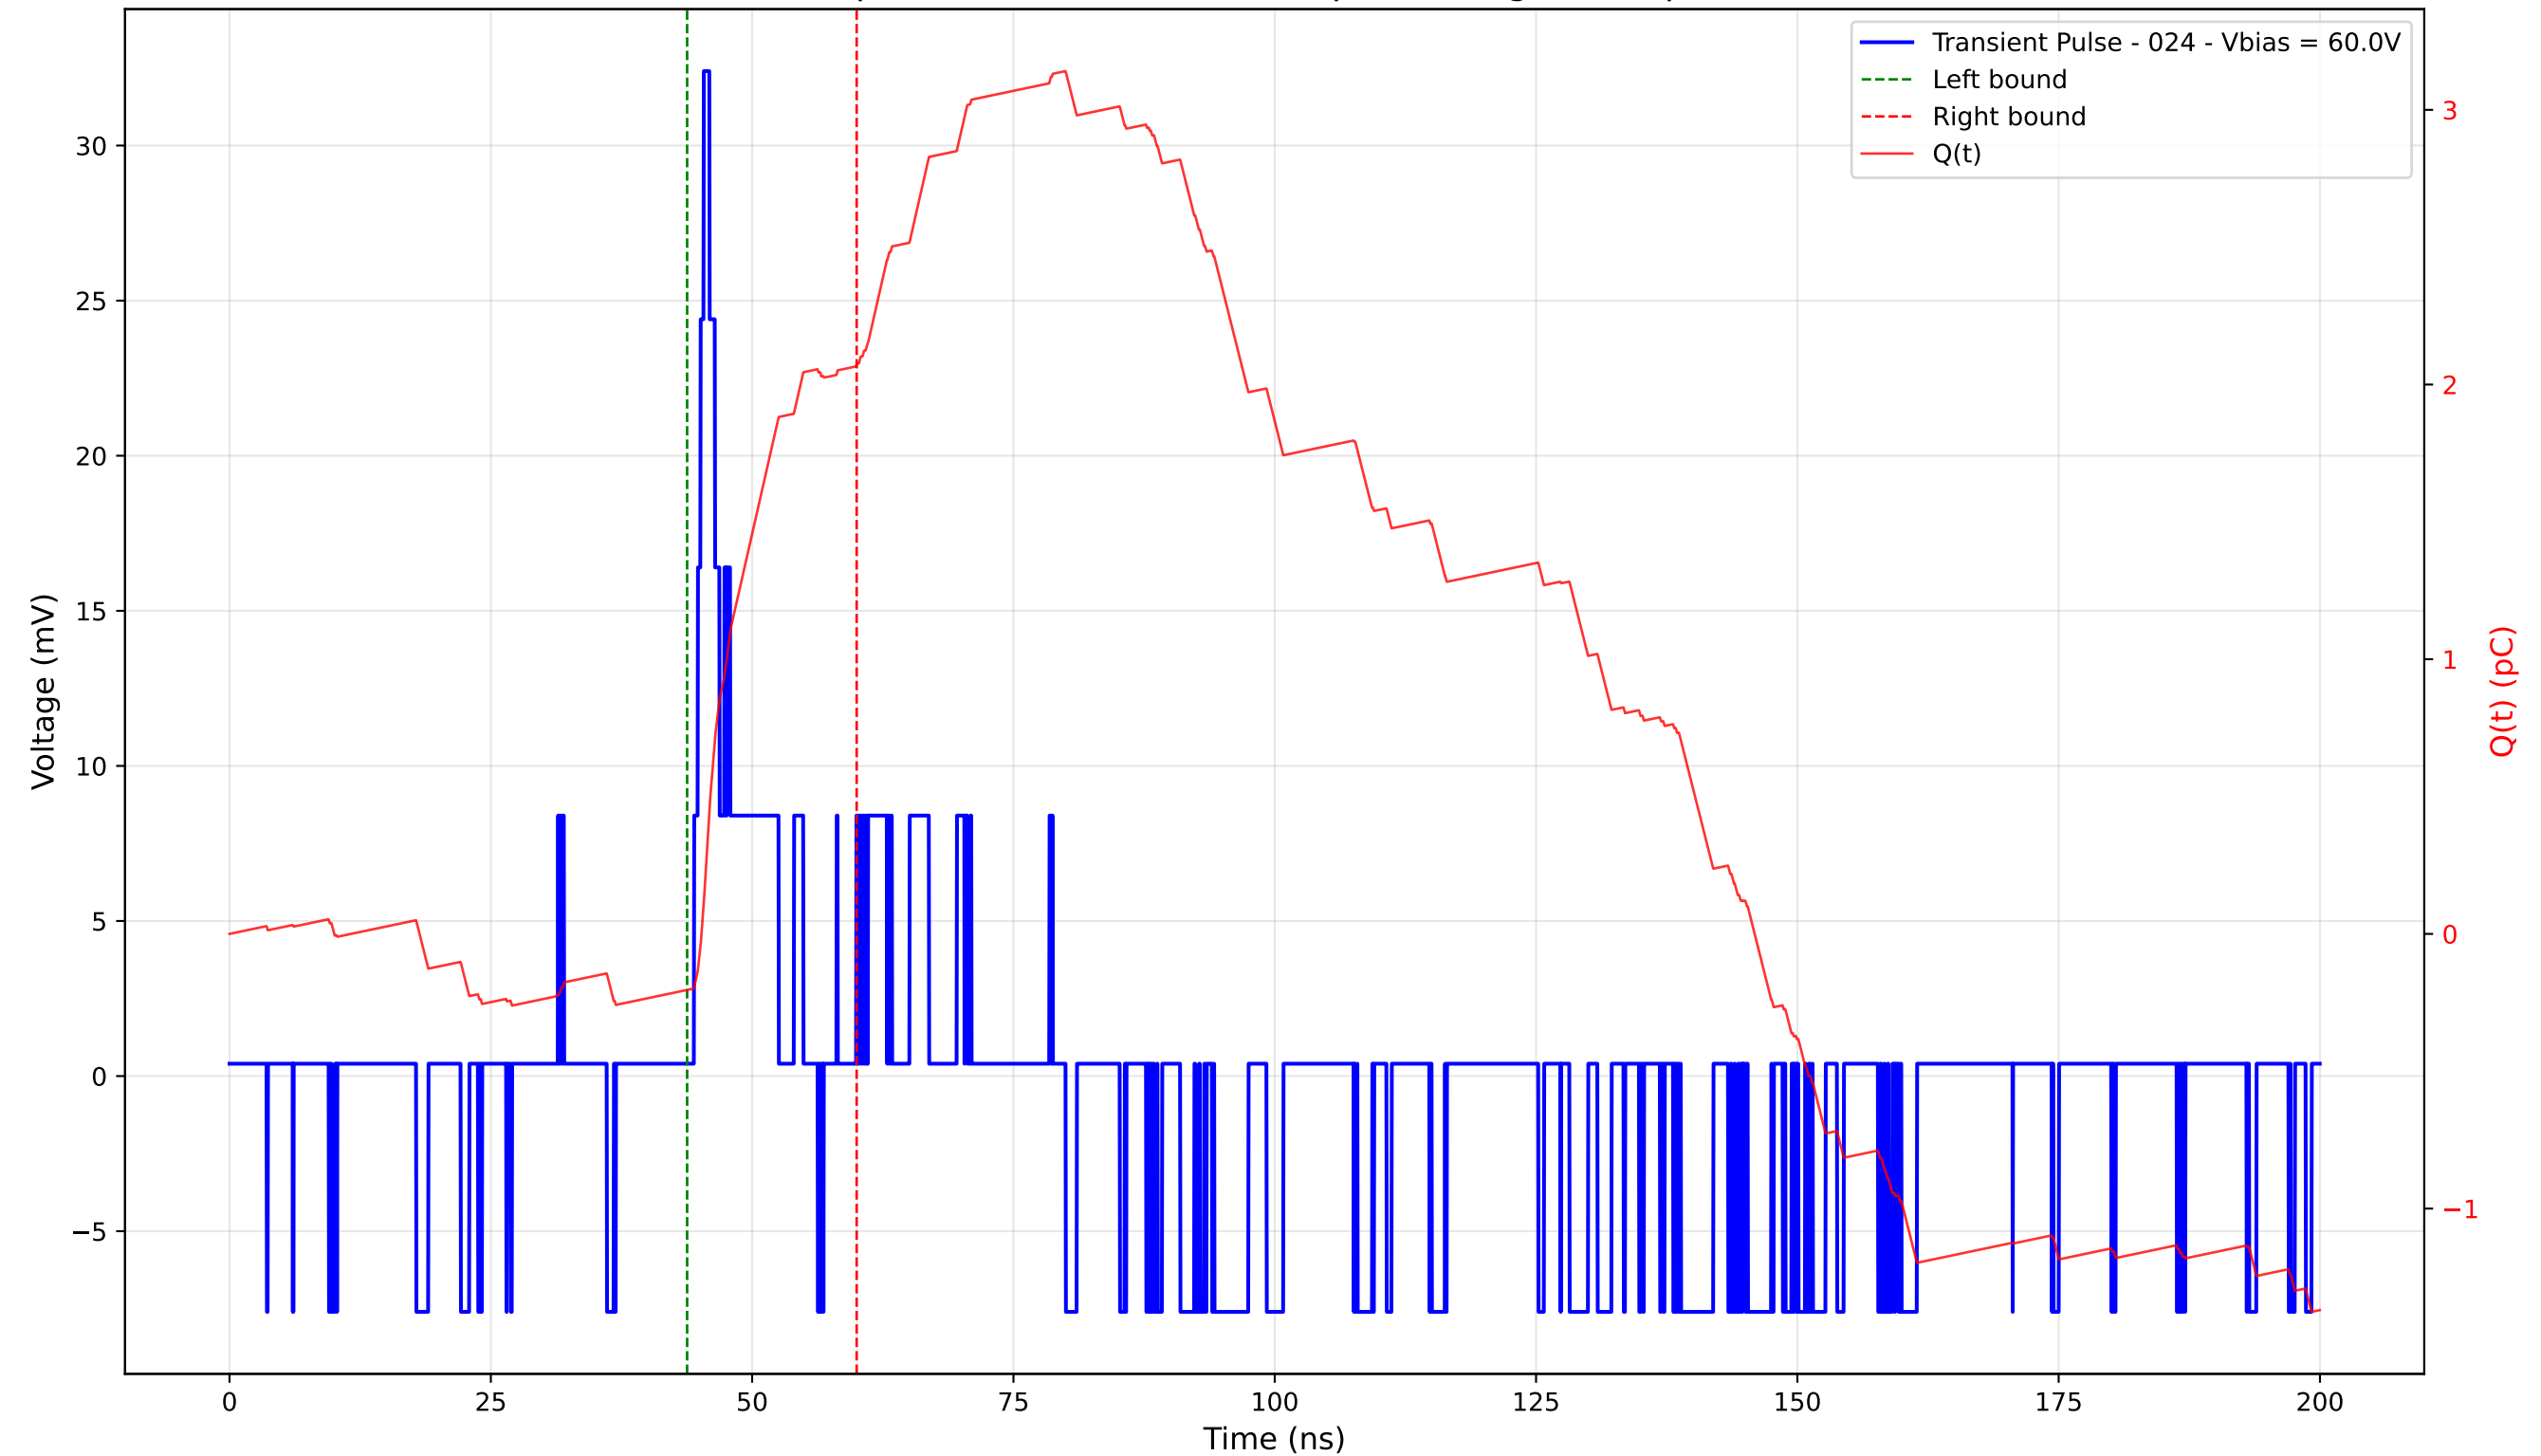


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 3.25 pC - Rise Time: 0.00 ns (N/A)

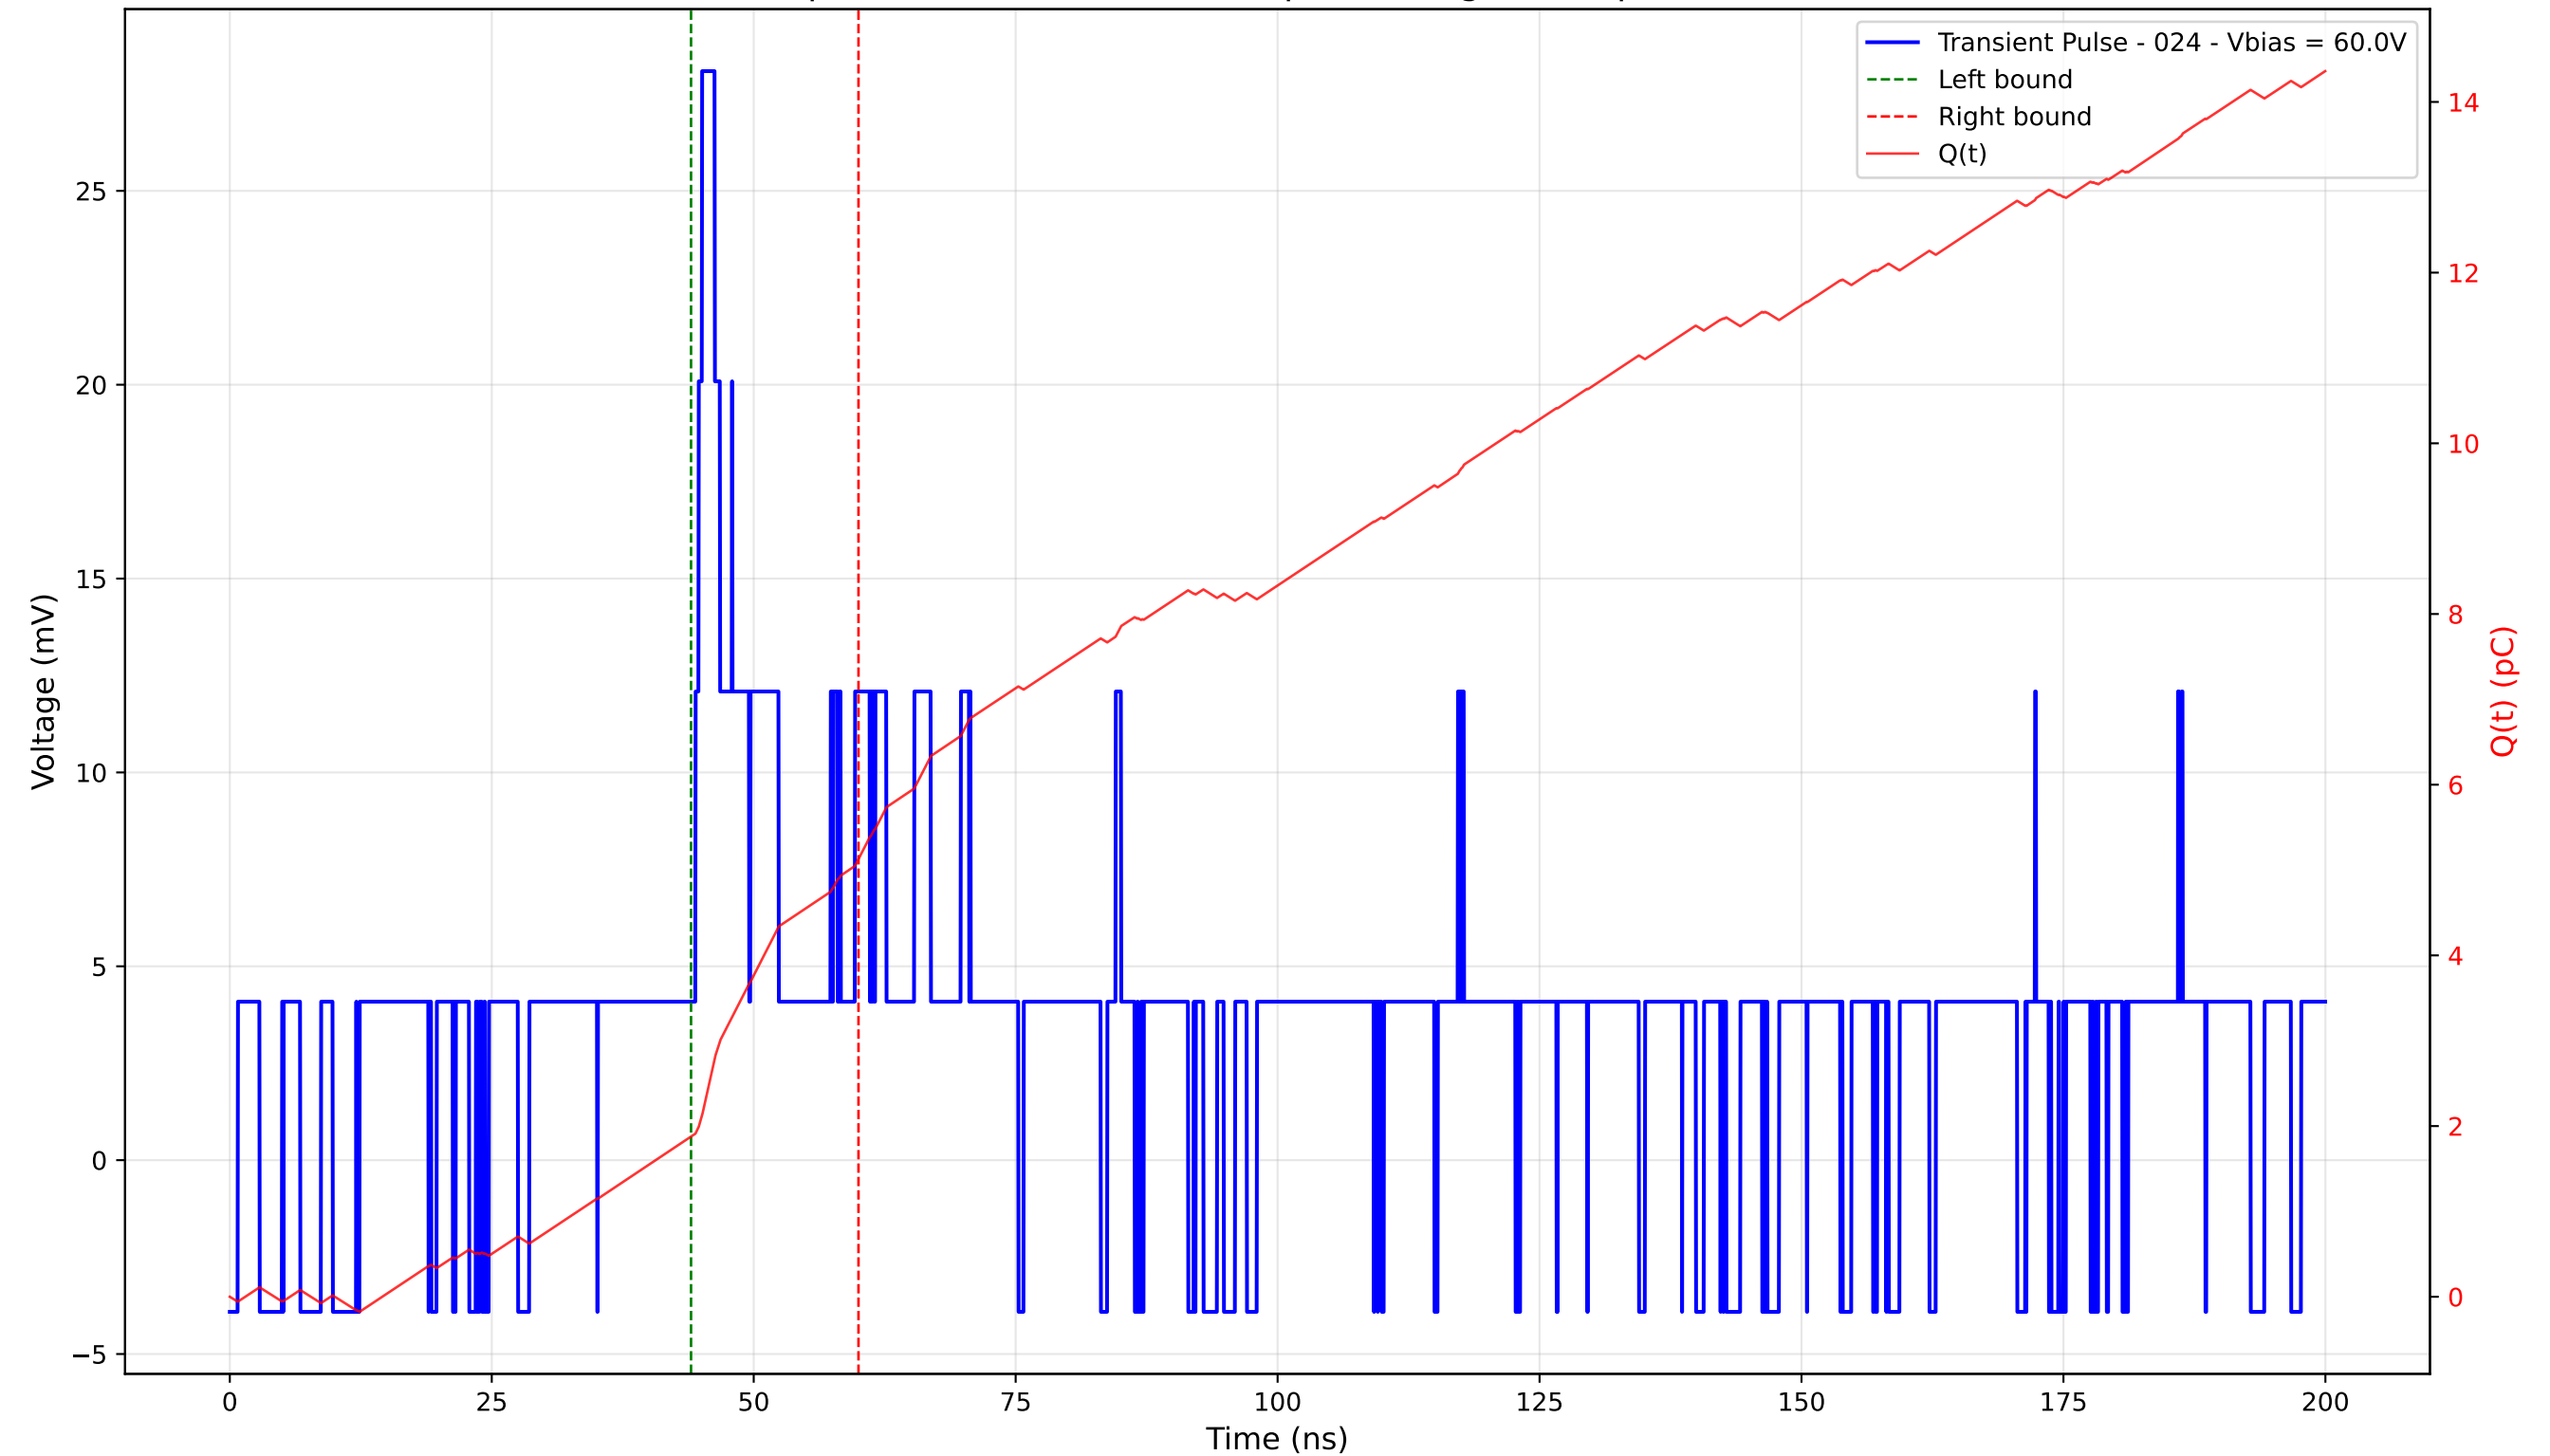


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 1.75 pC - Rise Time: 0.98 ns

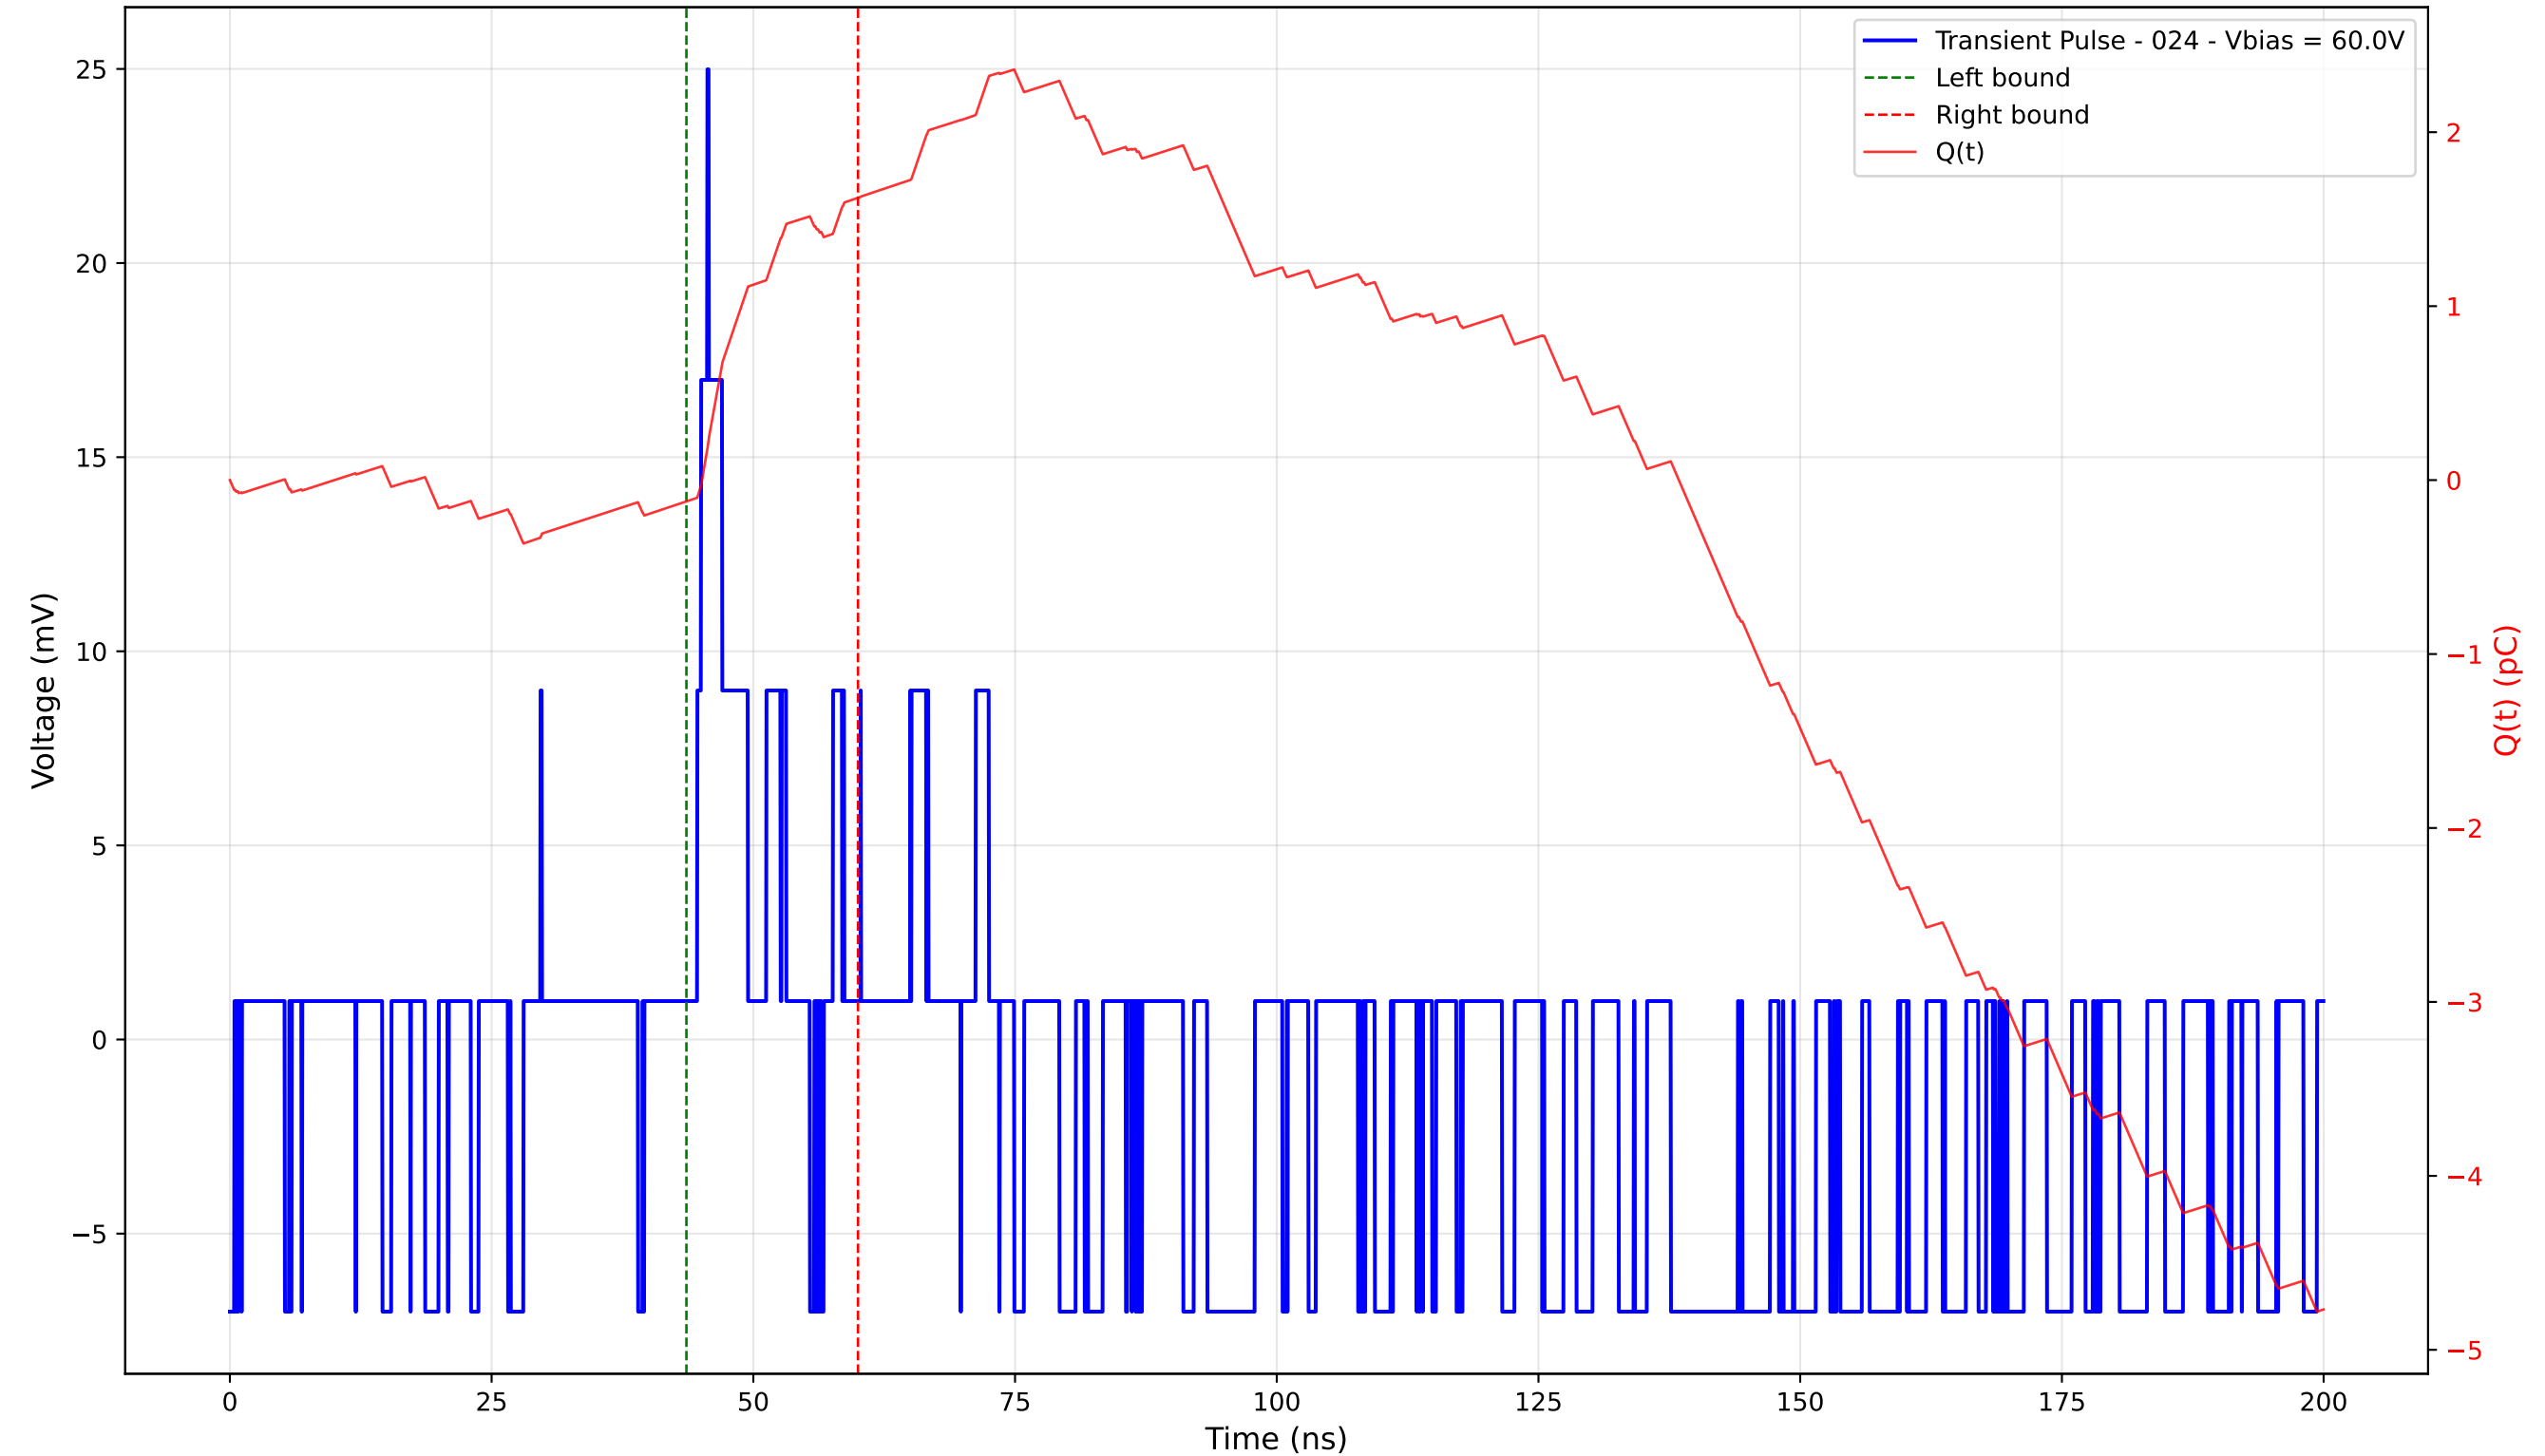

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 0.96 pC - Rise Time: 0.60 ns

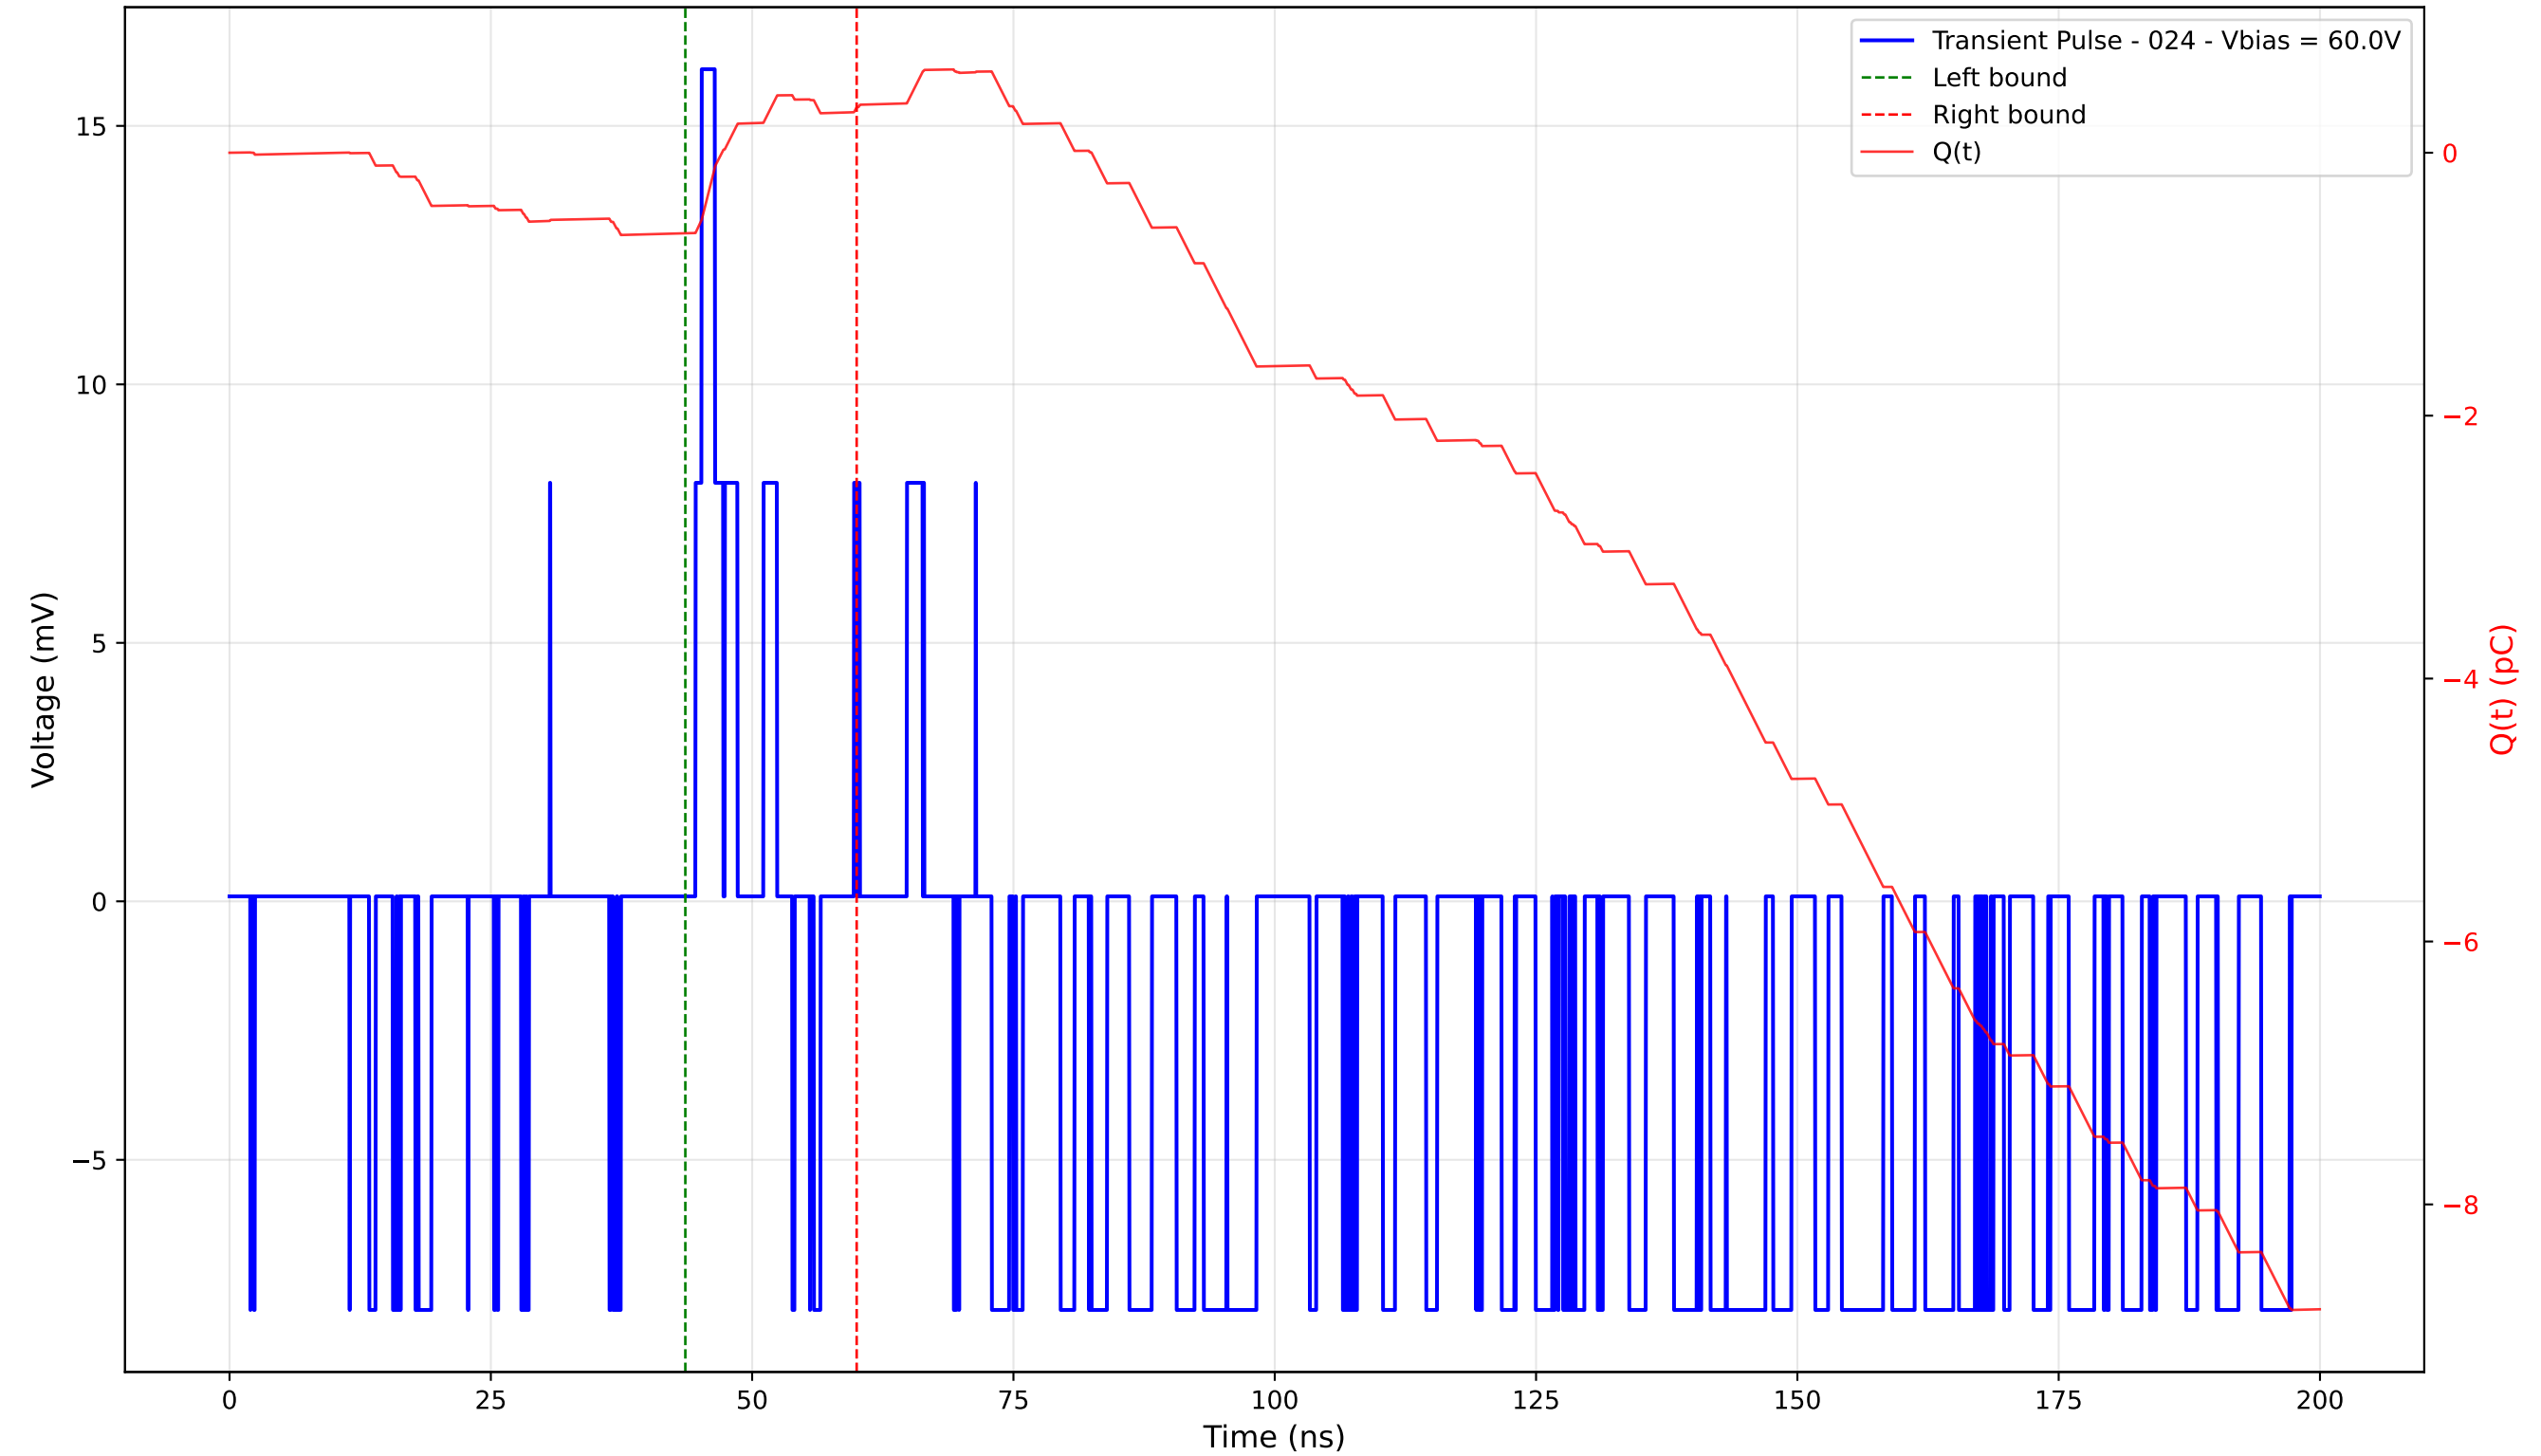

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 2.23 pC - Rise Time: 0.00 ns (N/A)

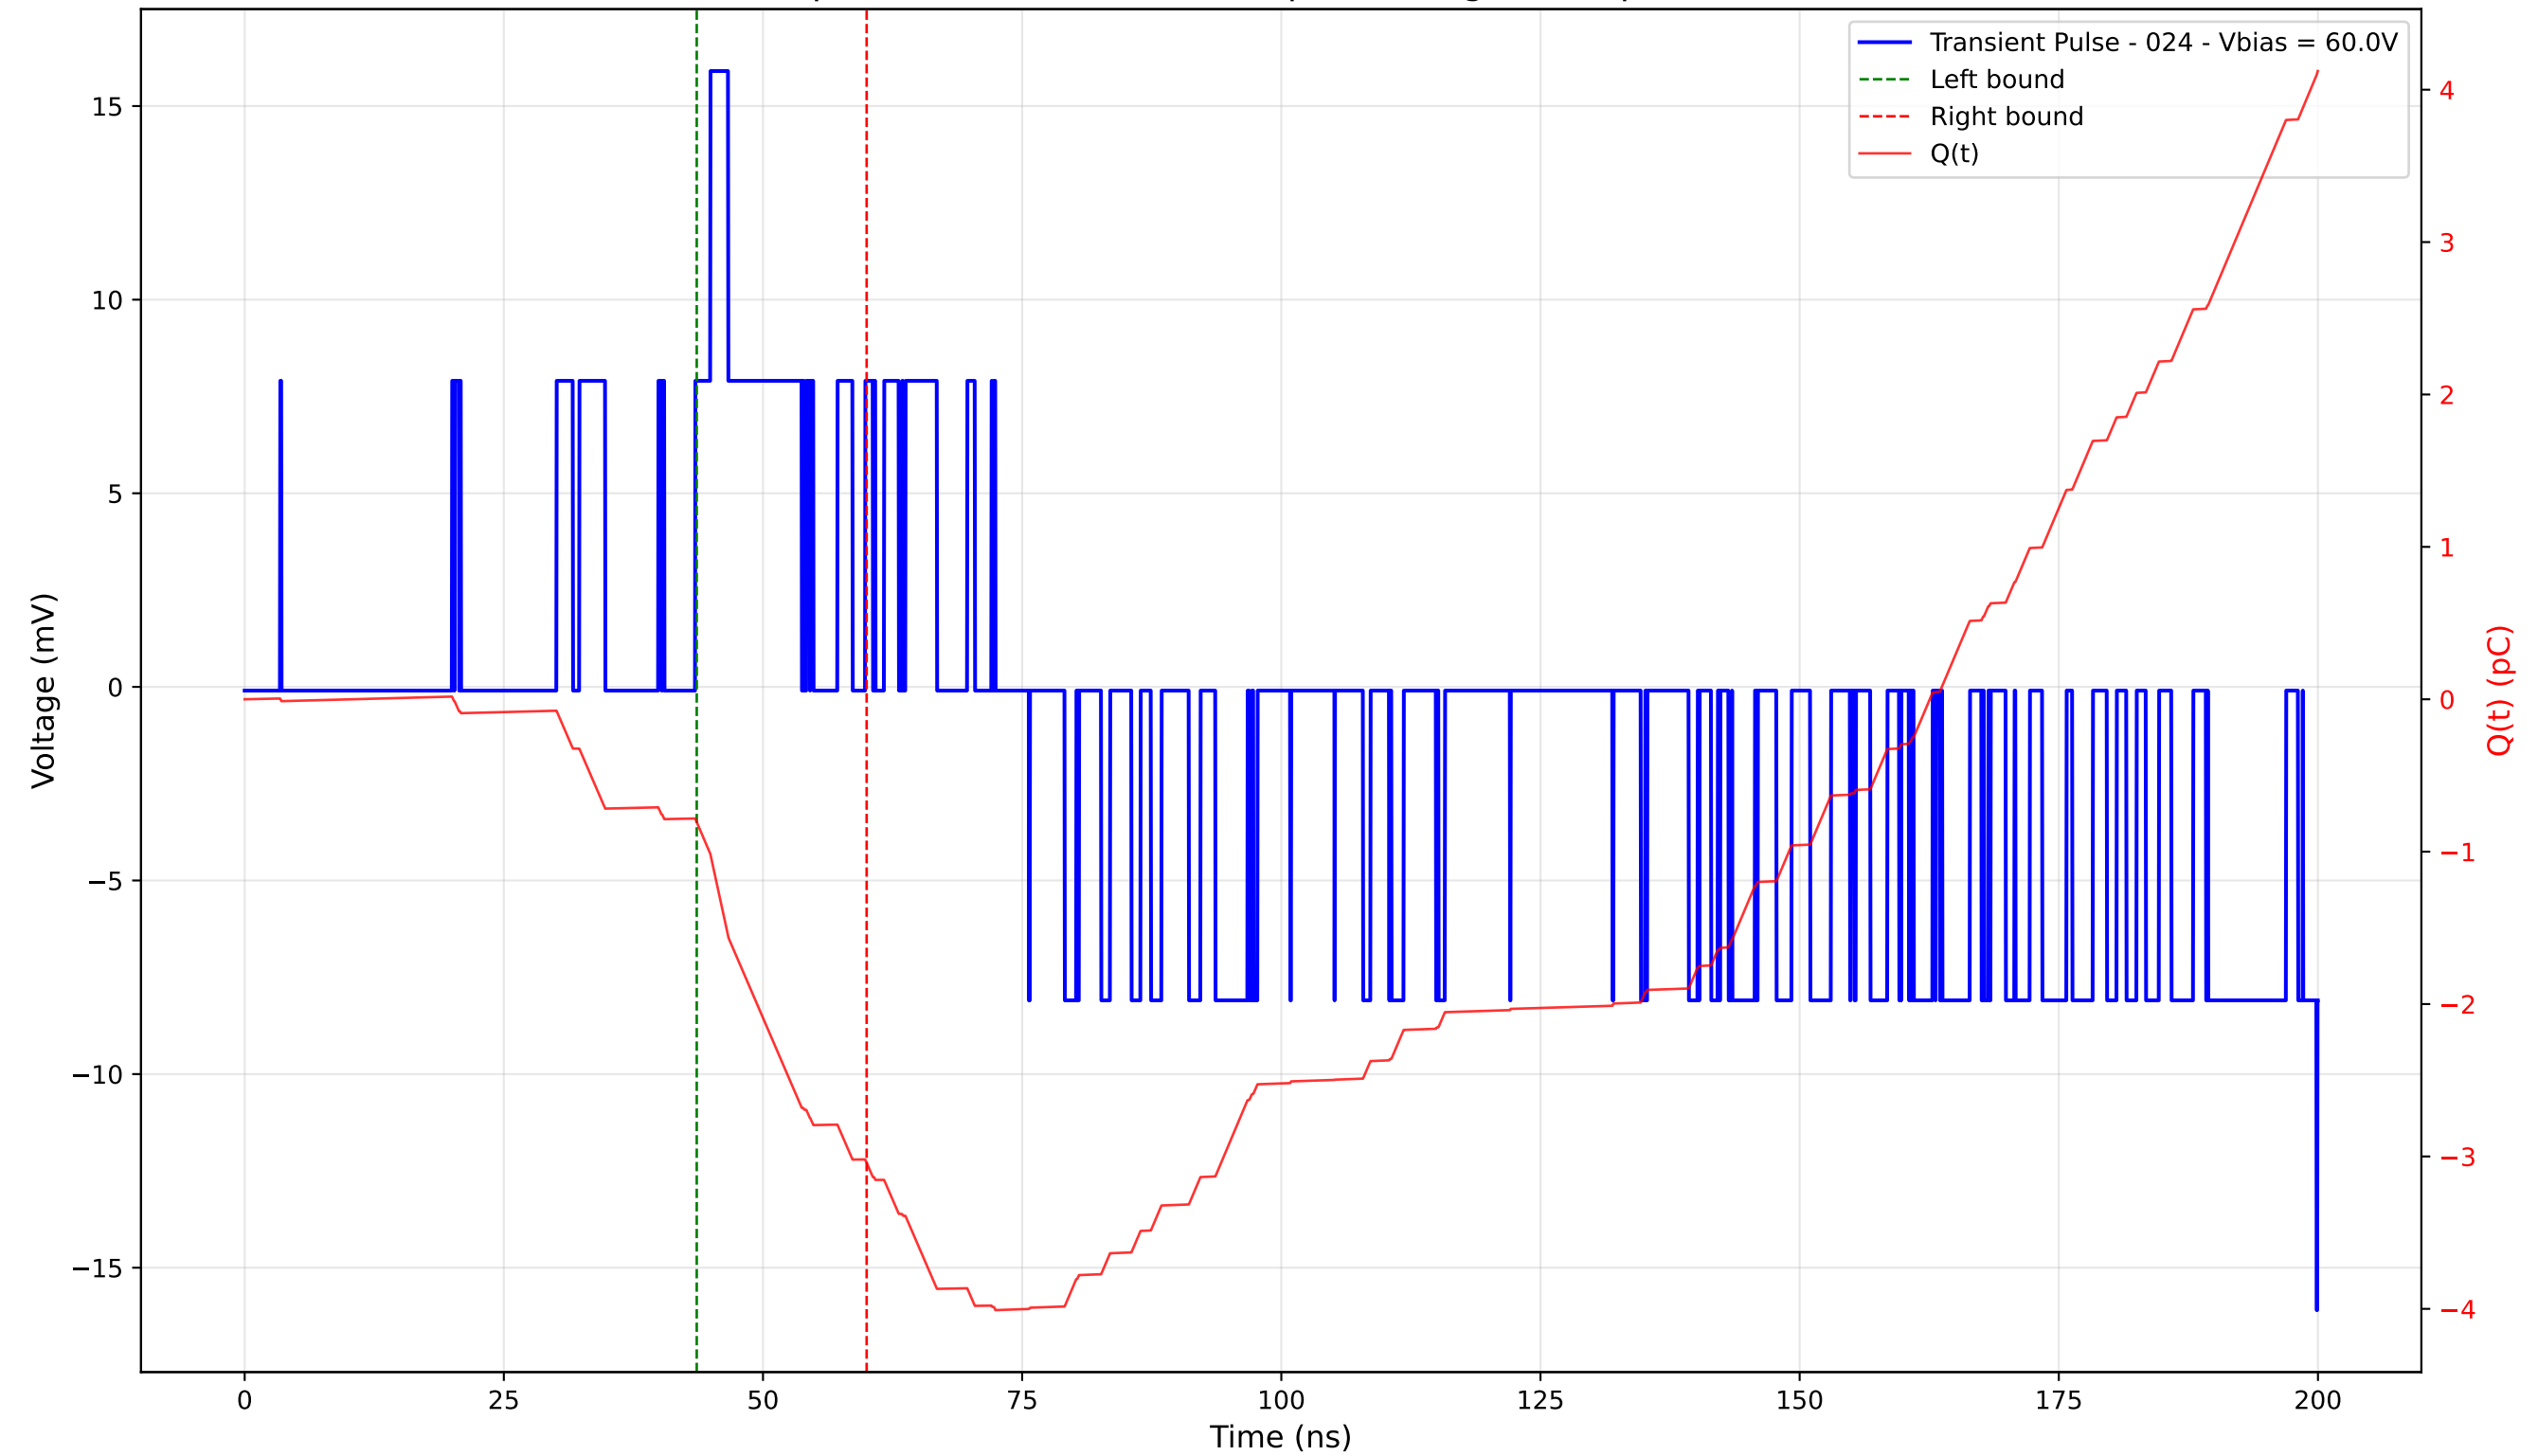

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 1.09 pC - Rise Time: 0.00 ns (N/A)

