



TCT Run TD_E_TCT_polished_6 Summary

Parameter	Value
Run	TD_E_TCT_polished_6
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	50.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080426\50V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	8/4/2026
Gain Constant	N/A


Collected Charge

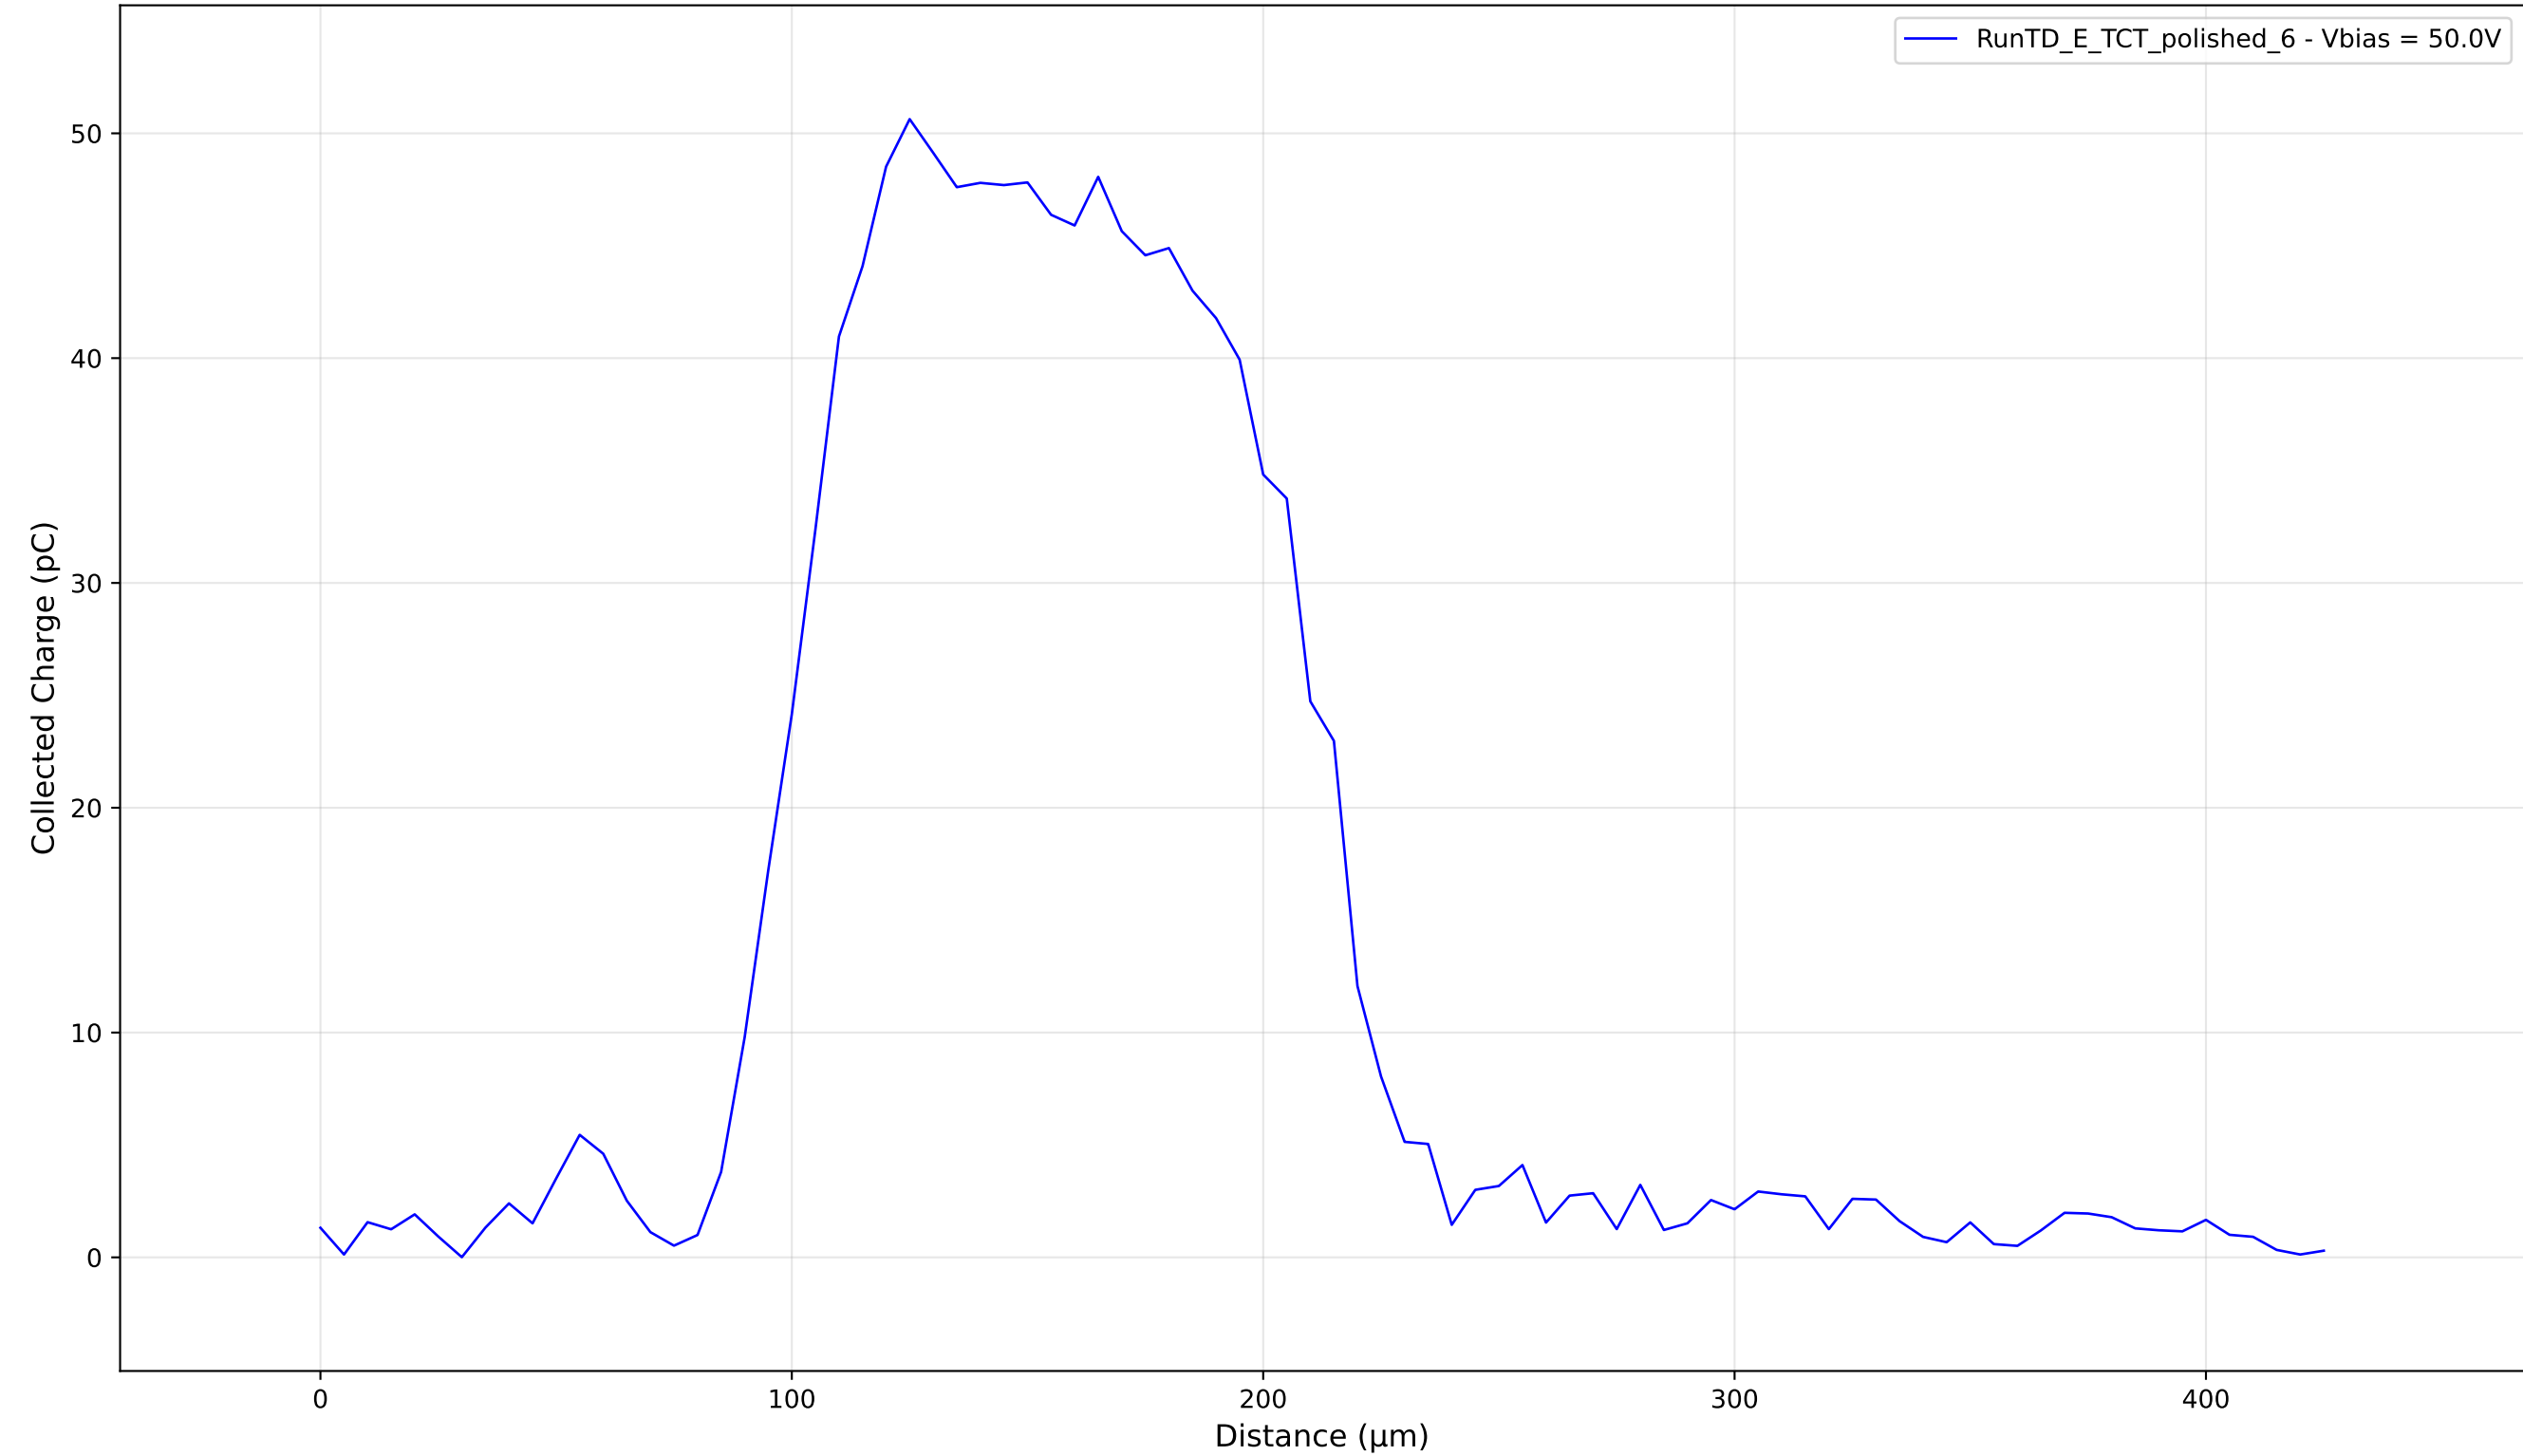


Collected Charge

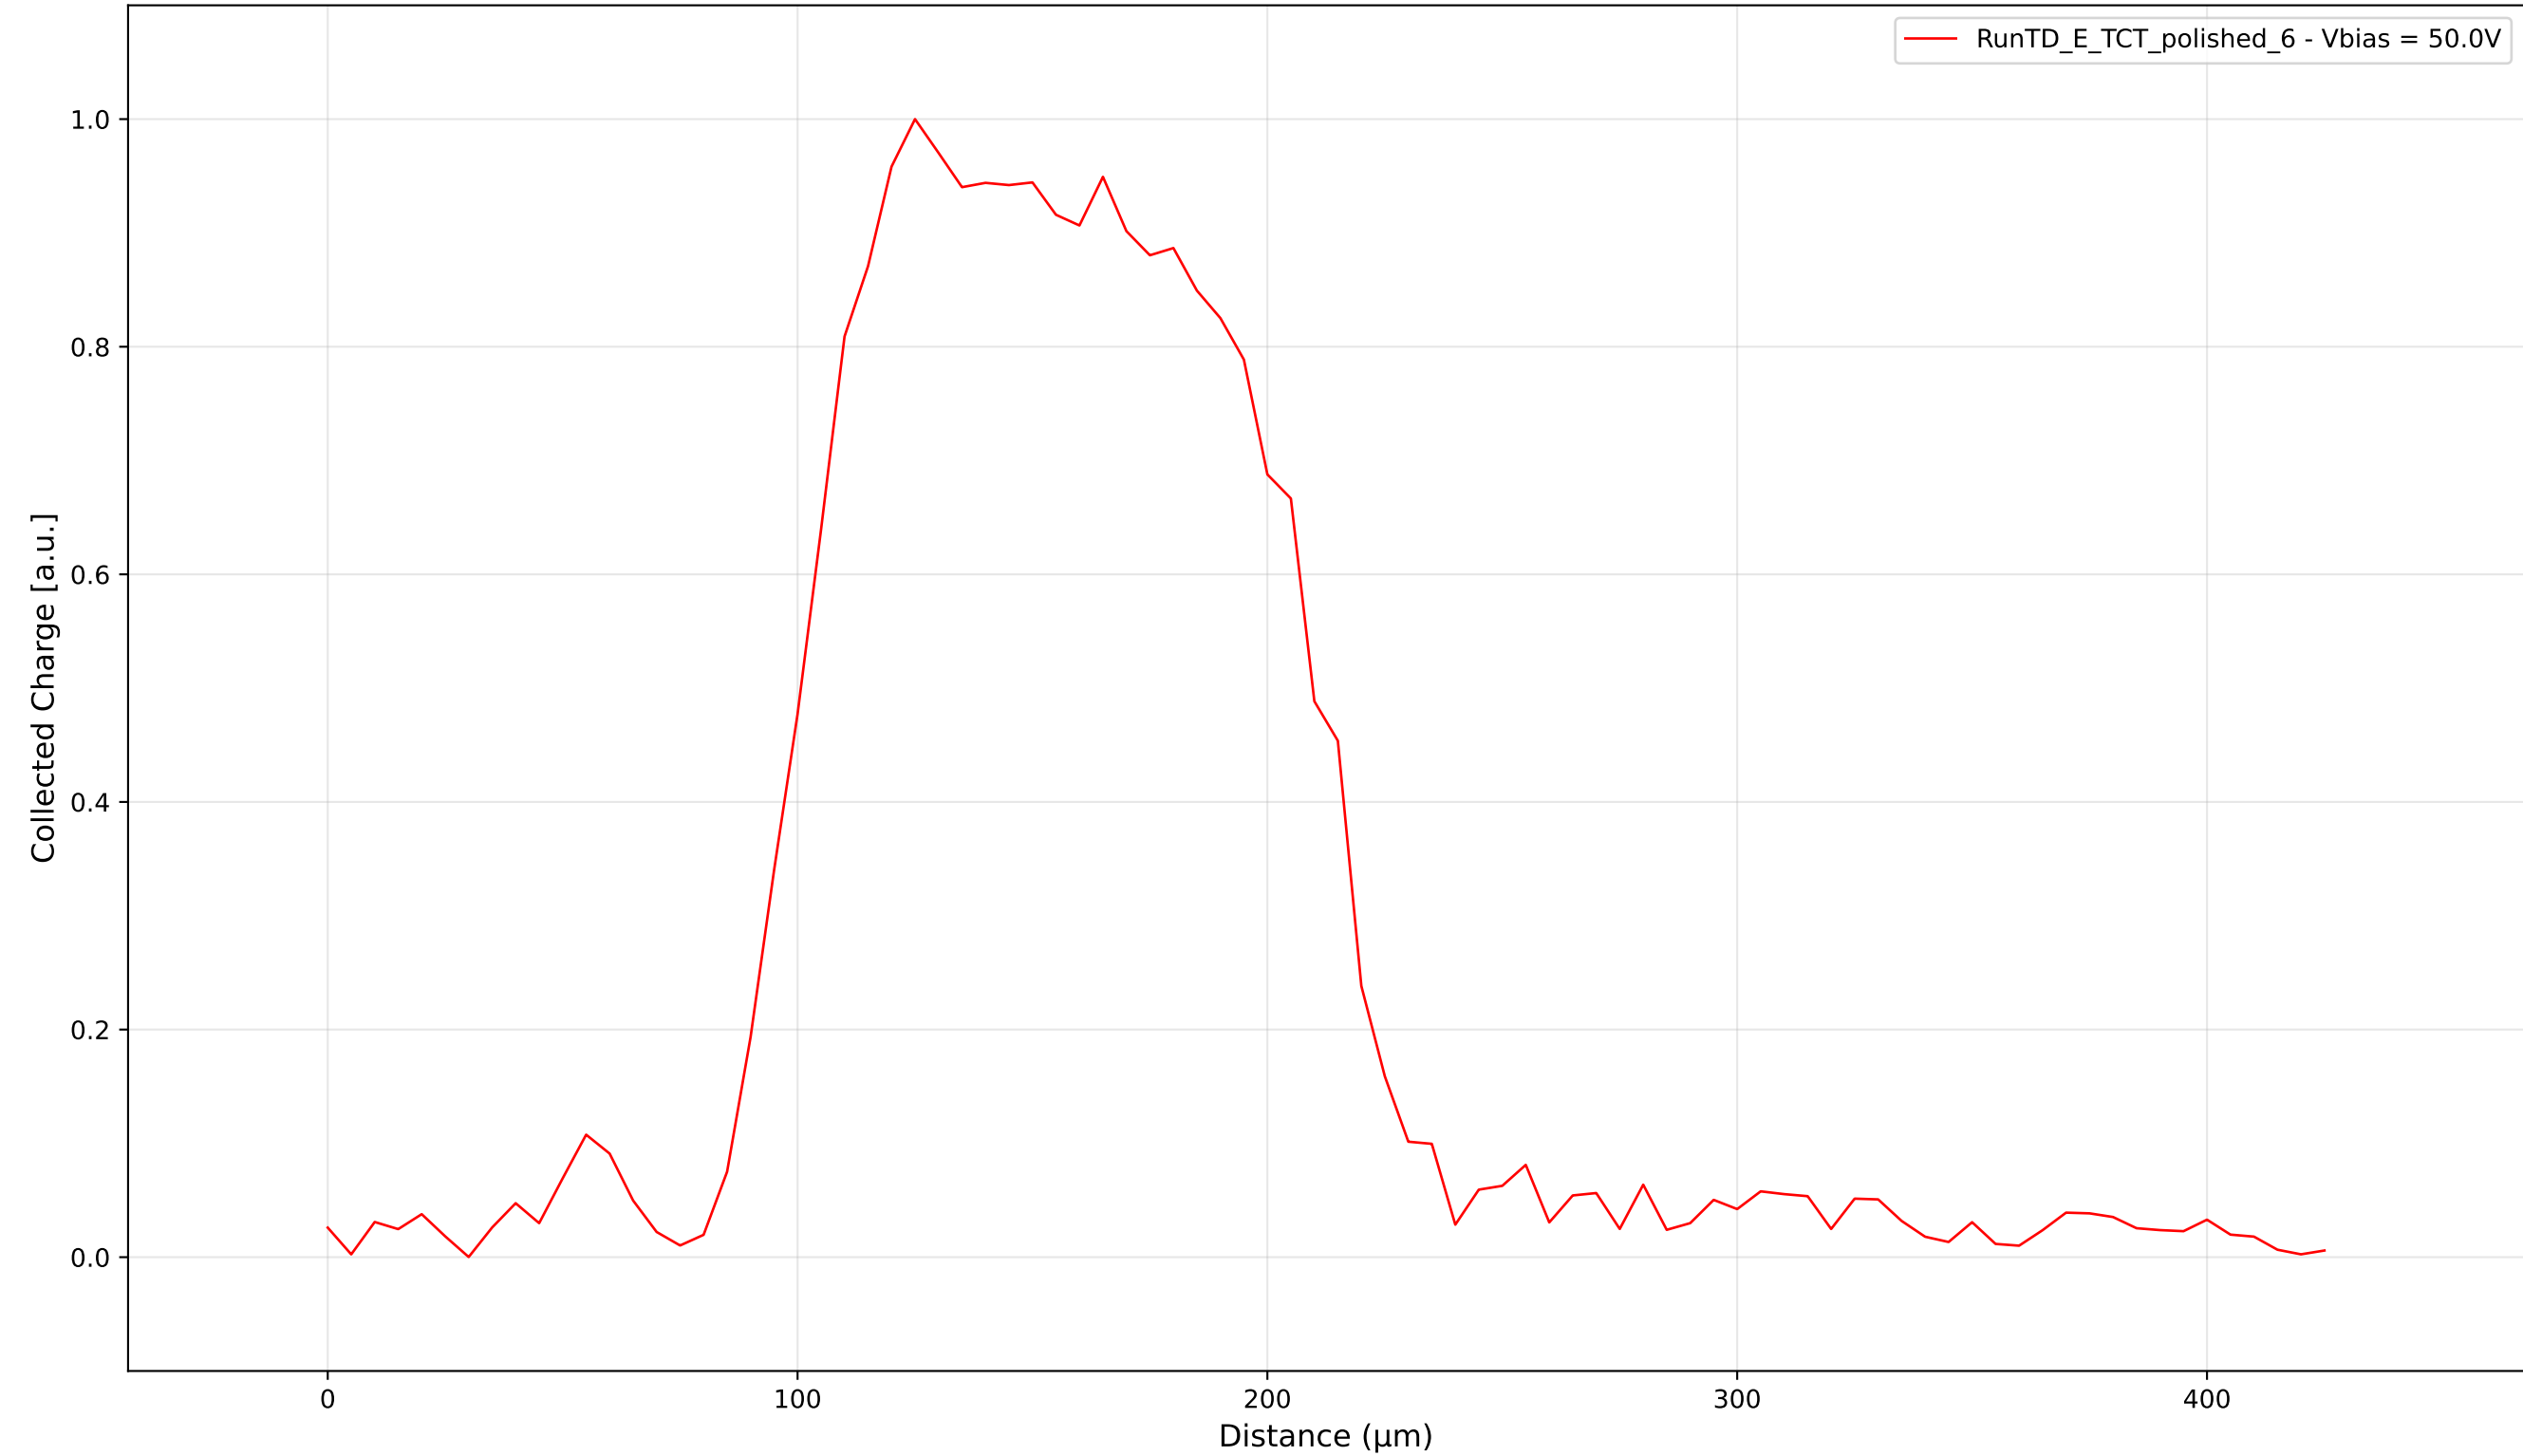


Rise Time

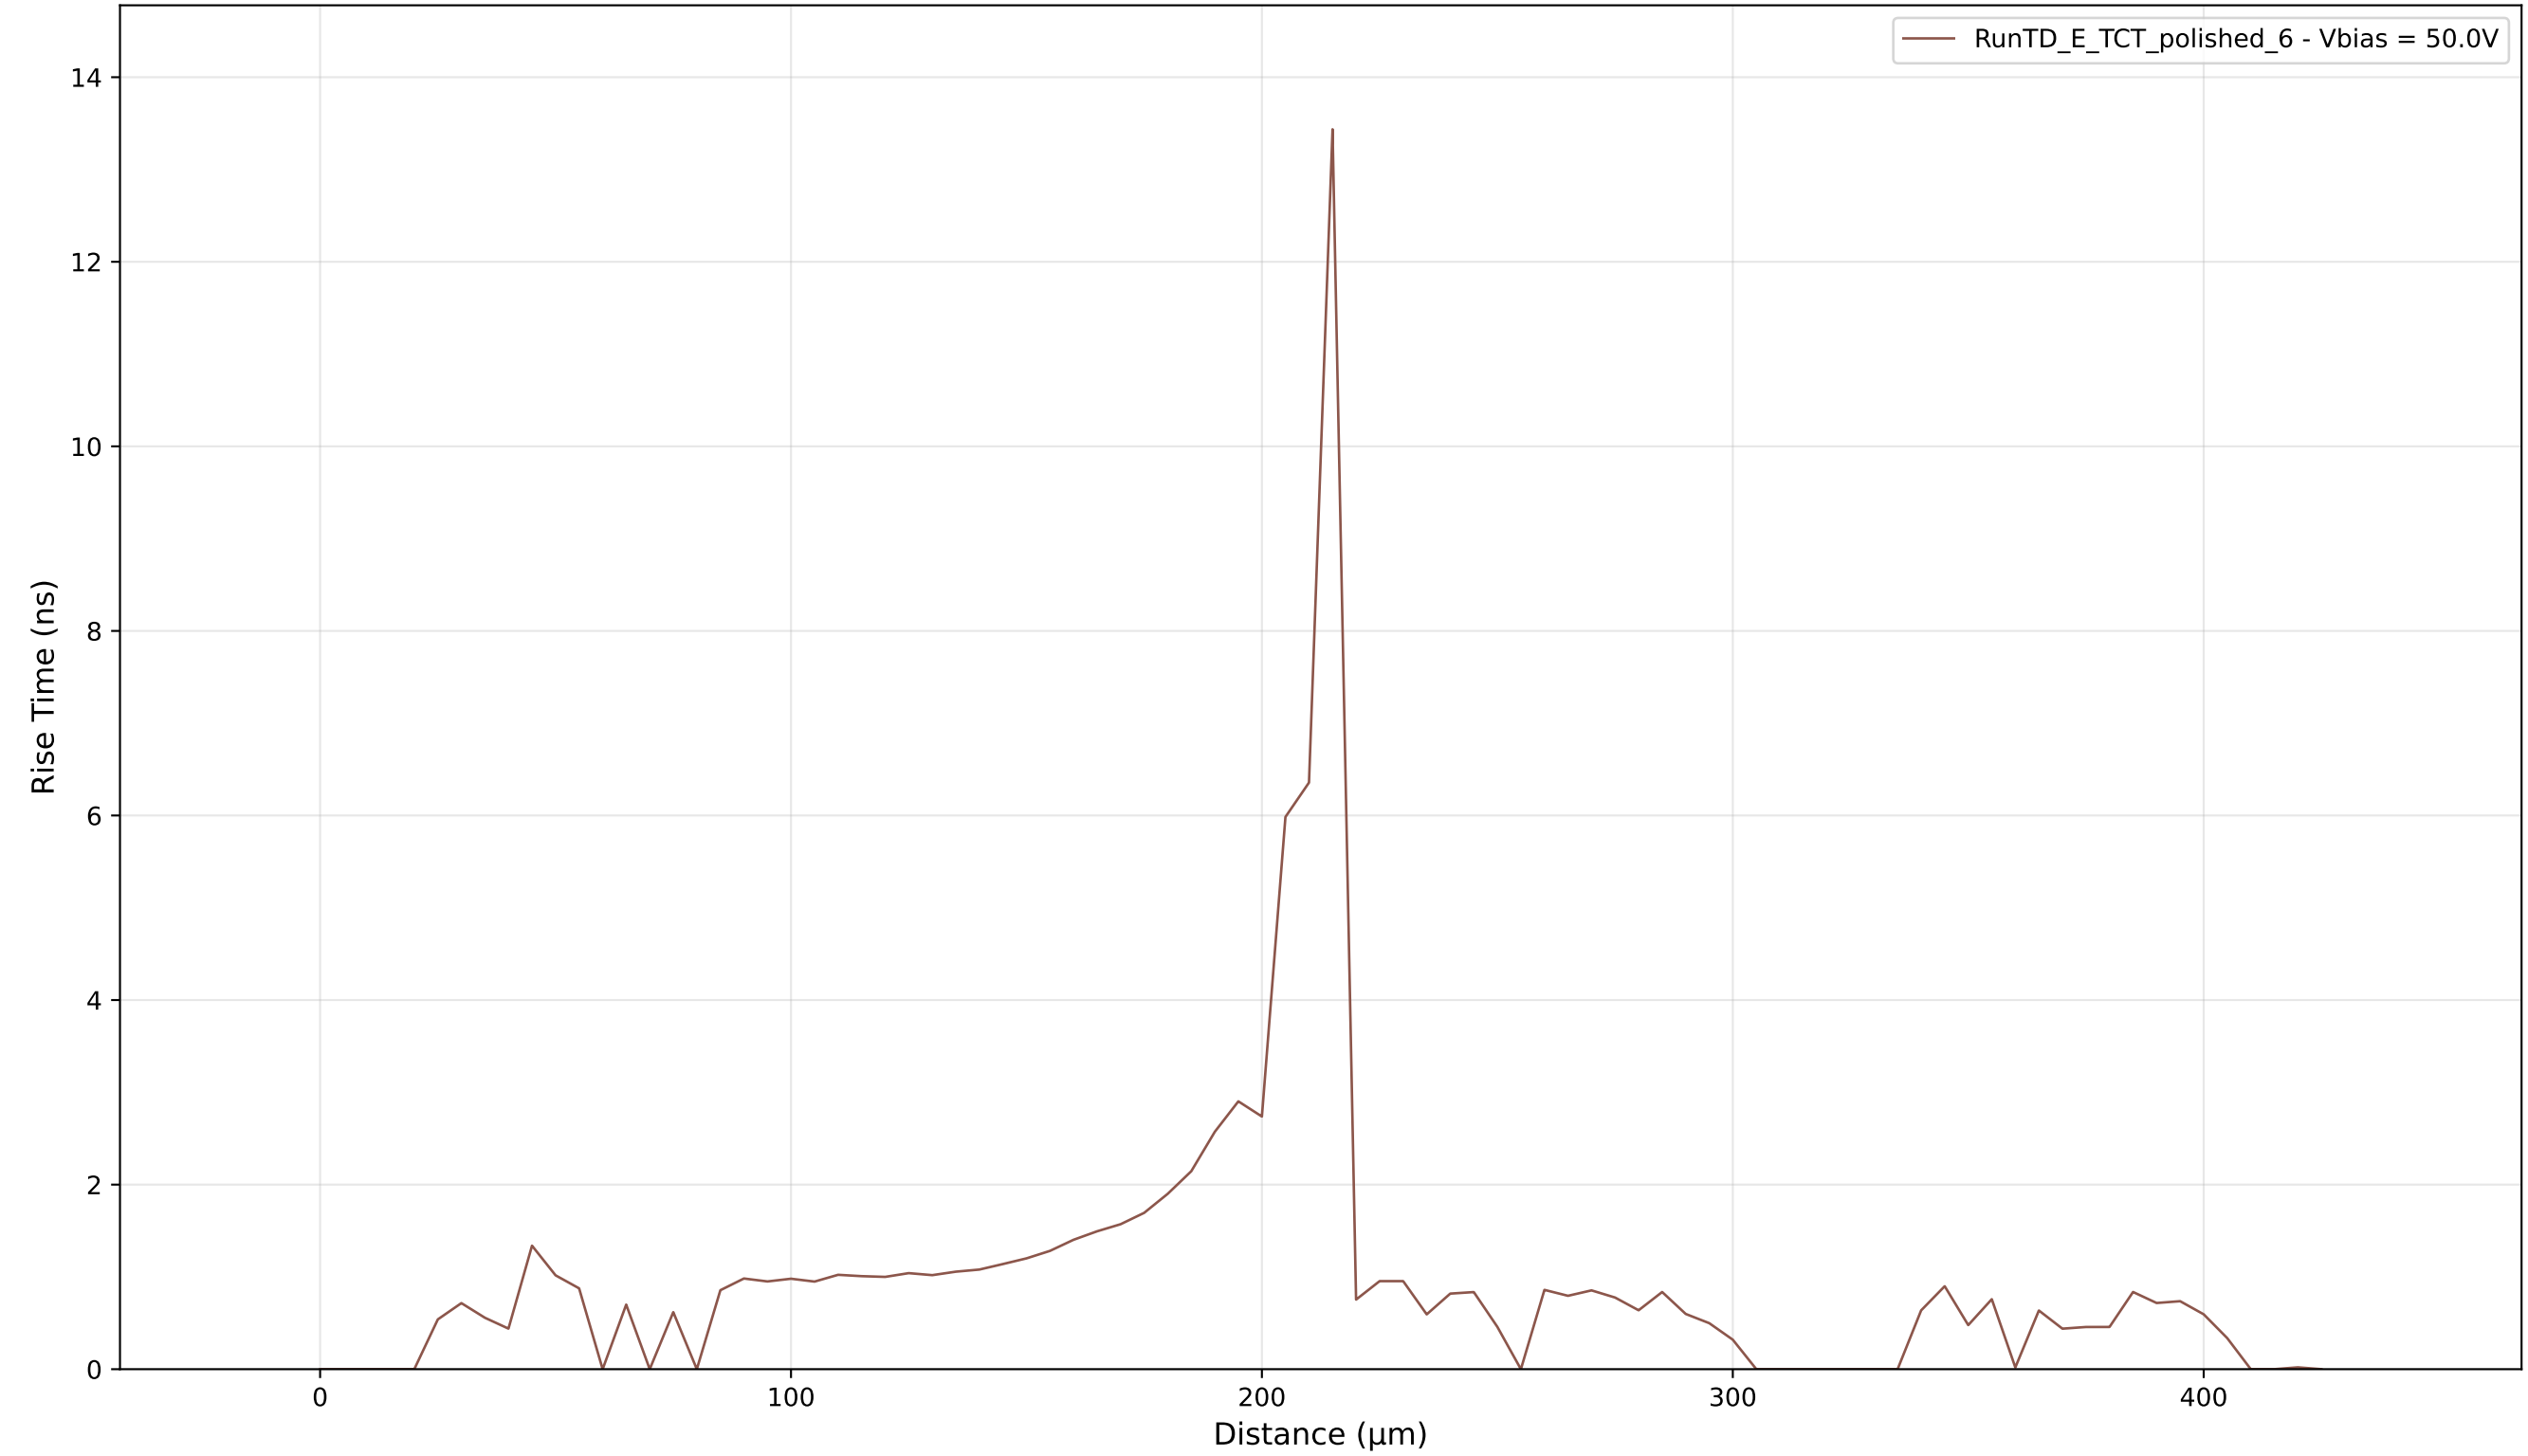


Amplitude

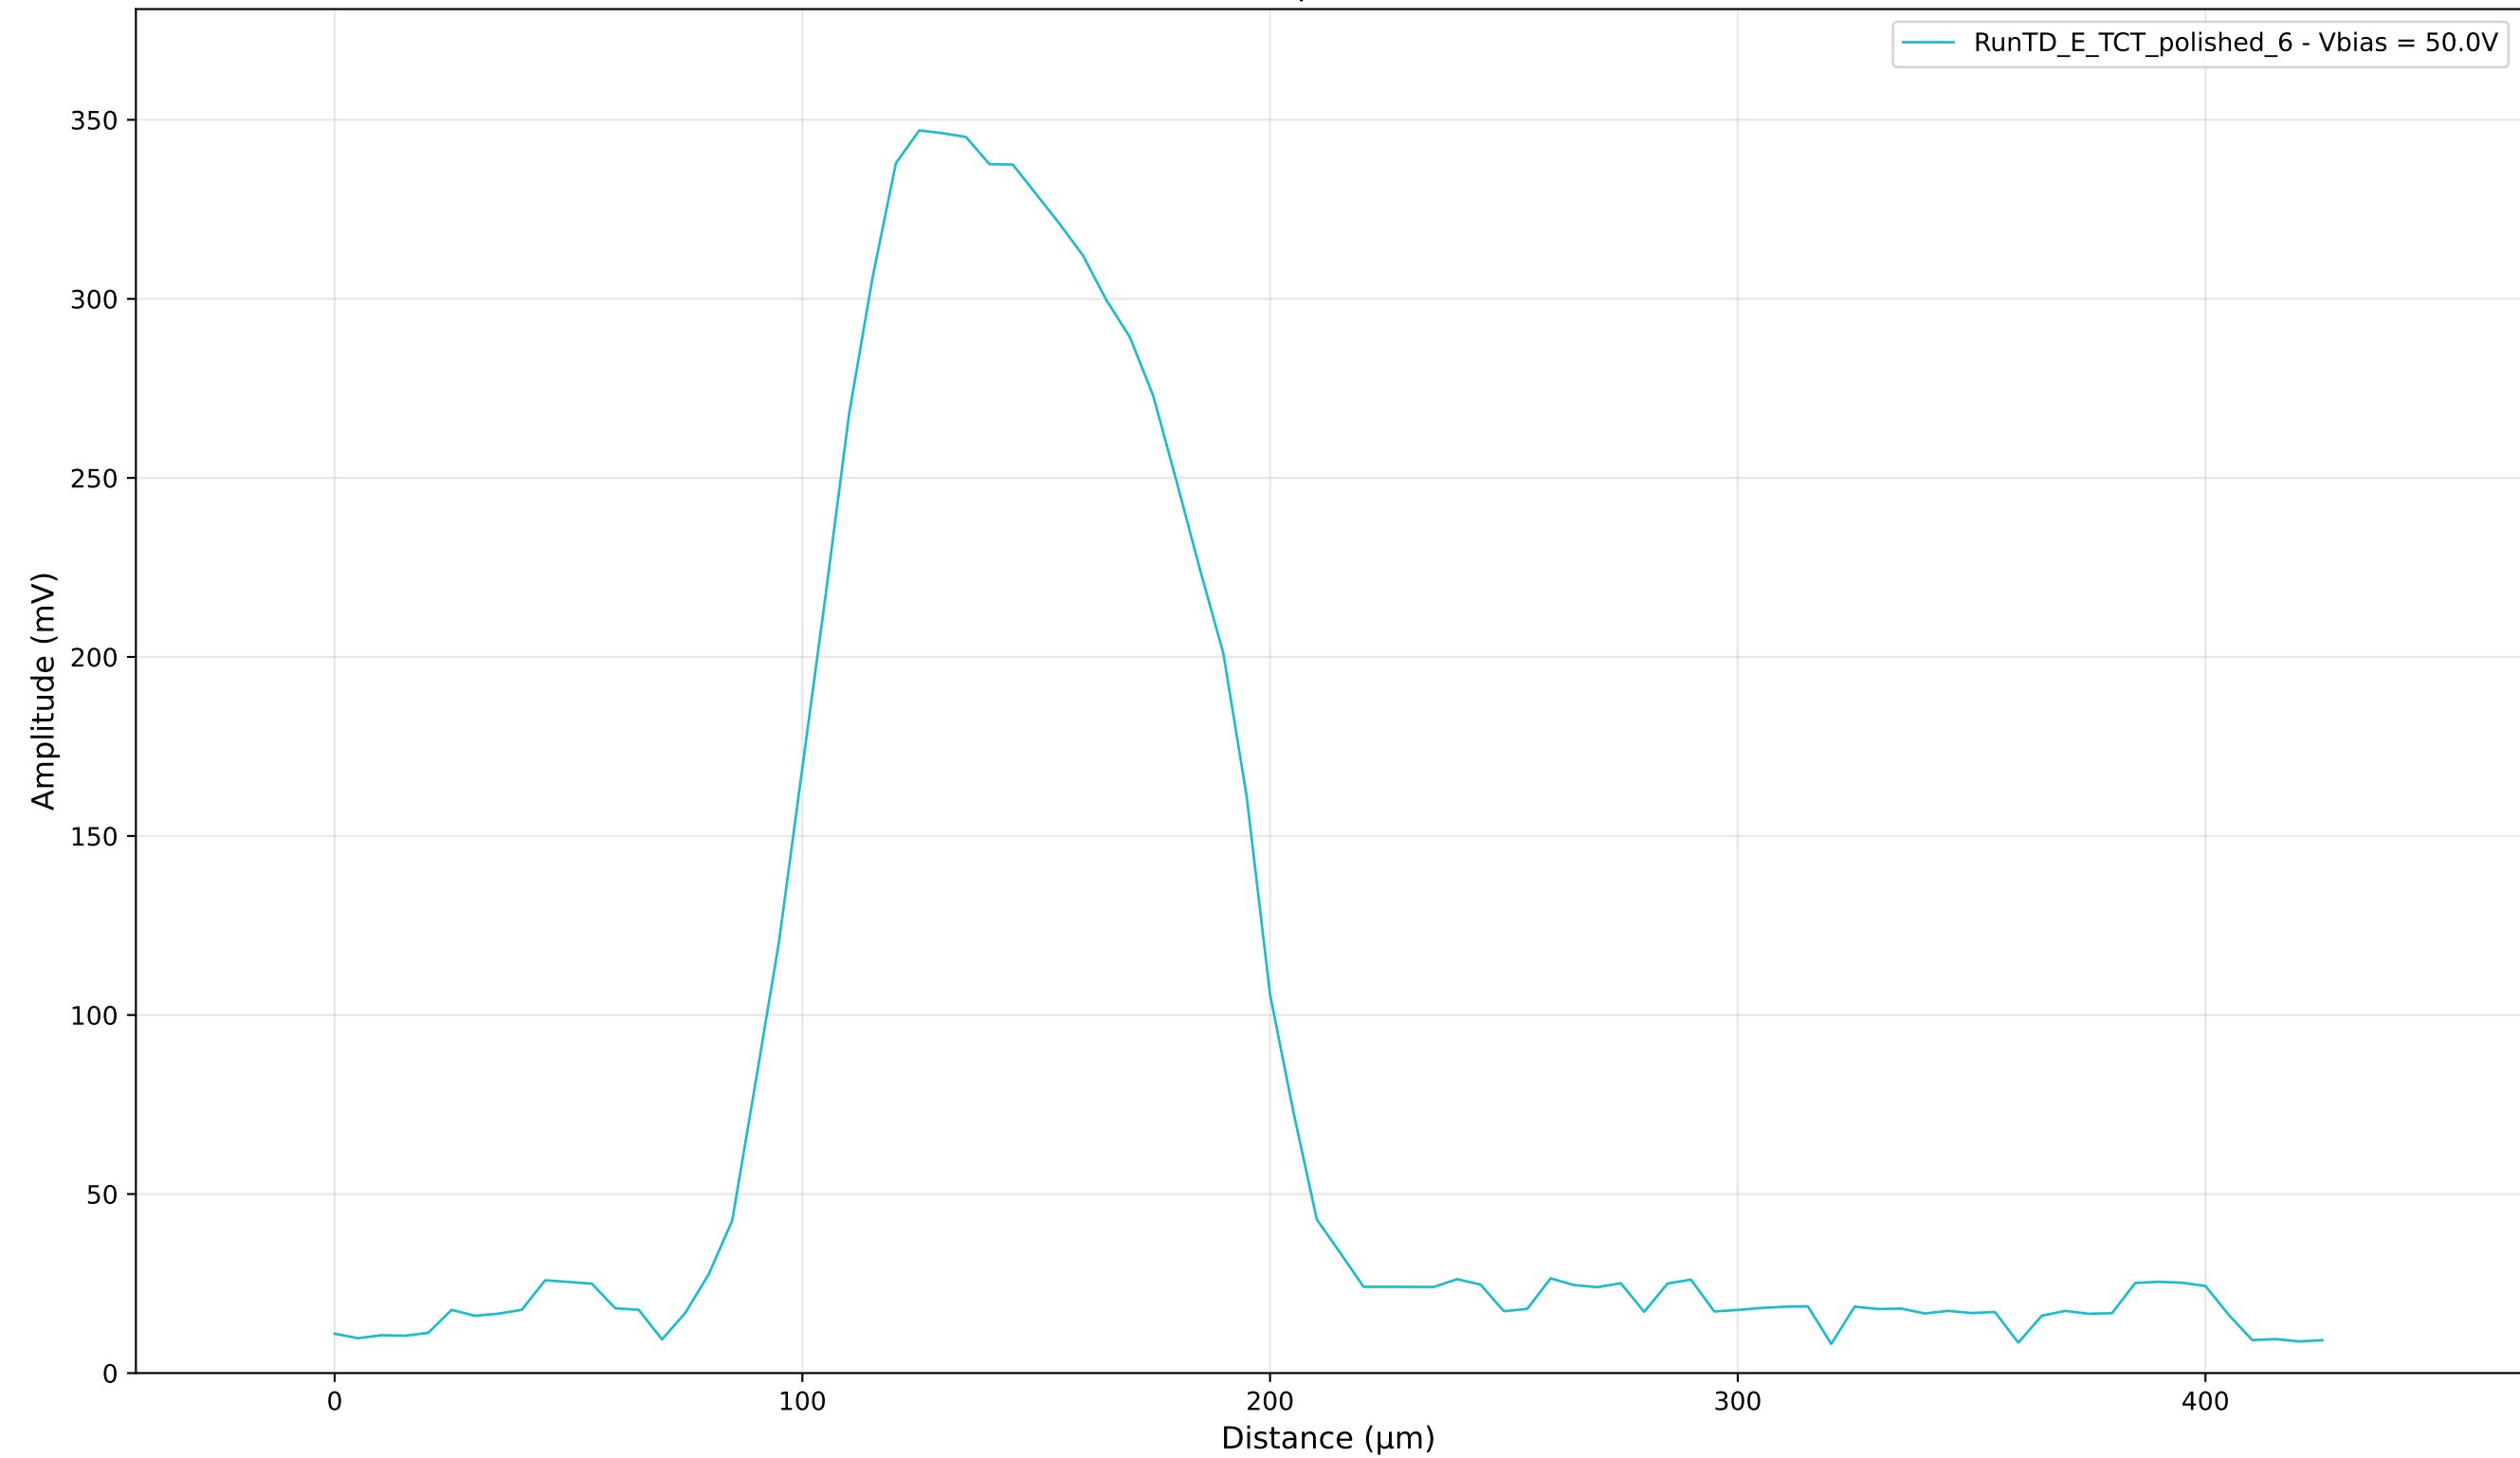


FWHM

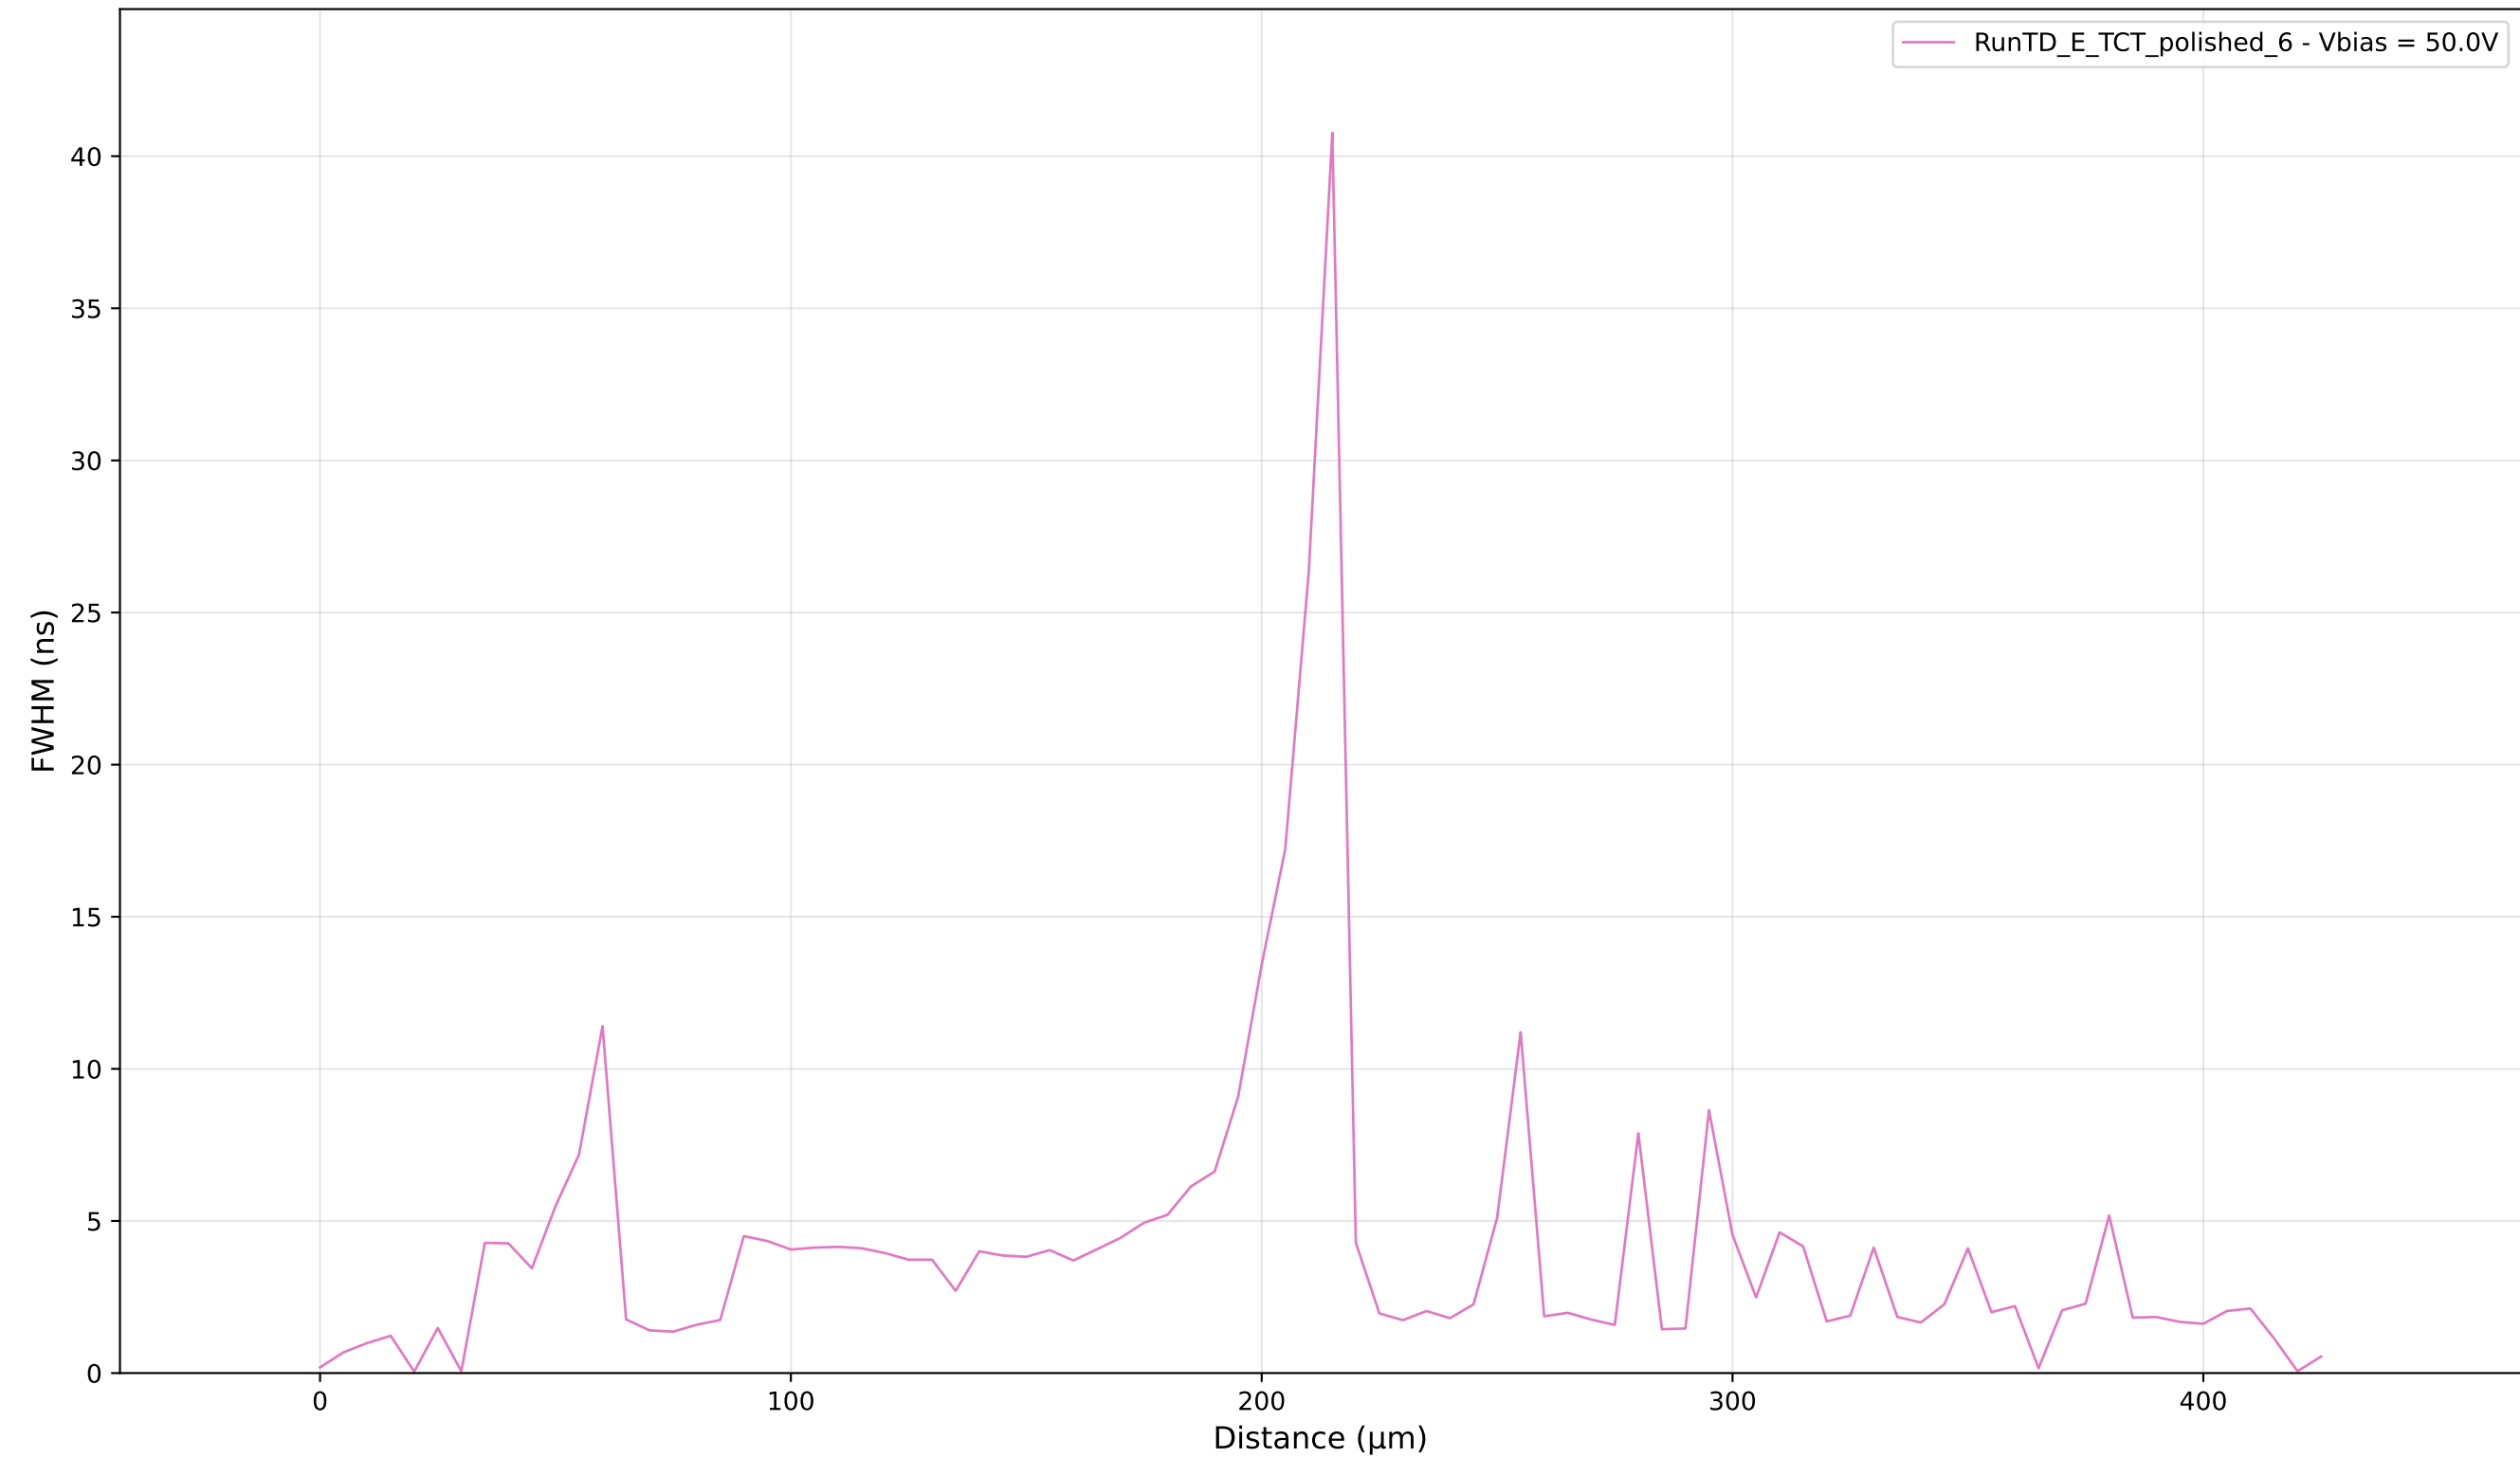


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 1.31 pC - Rise Time: 0.00 ns (N/A)

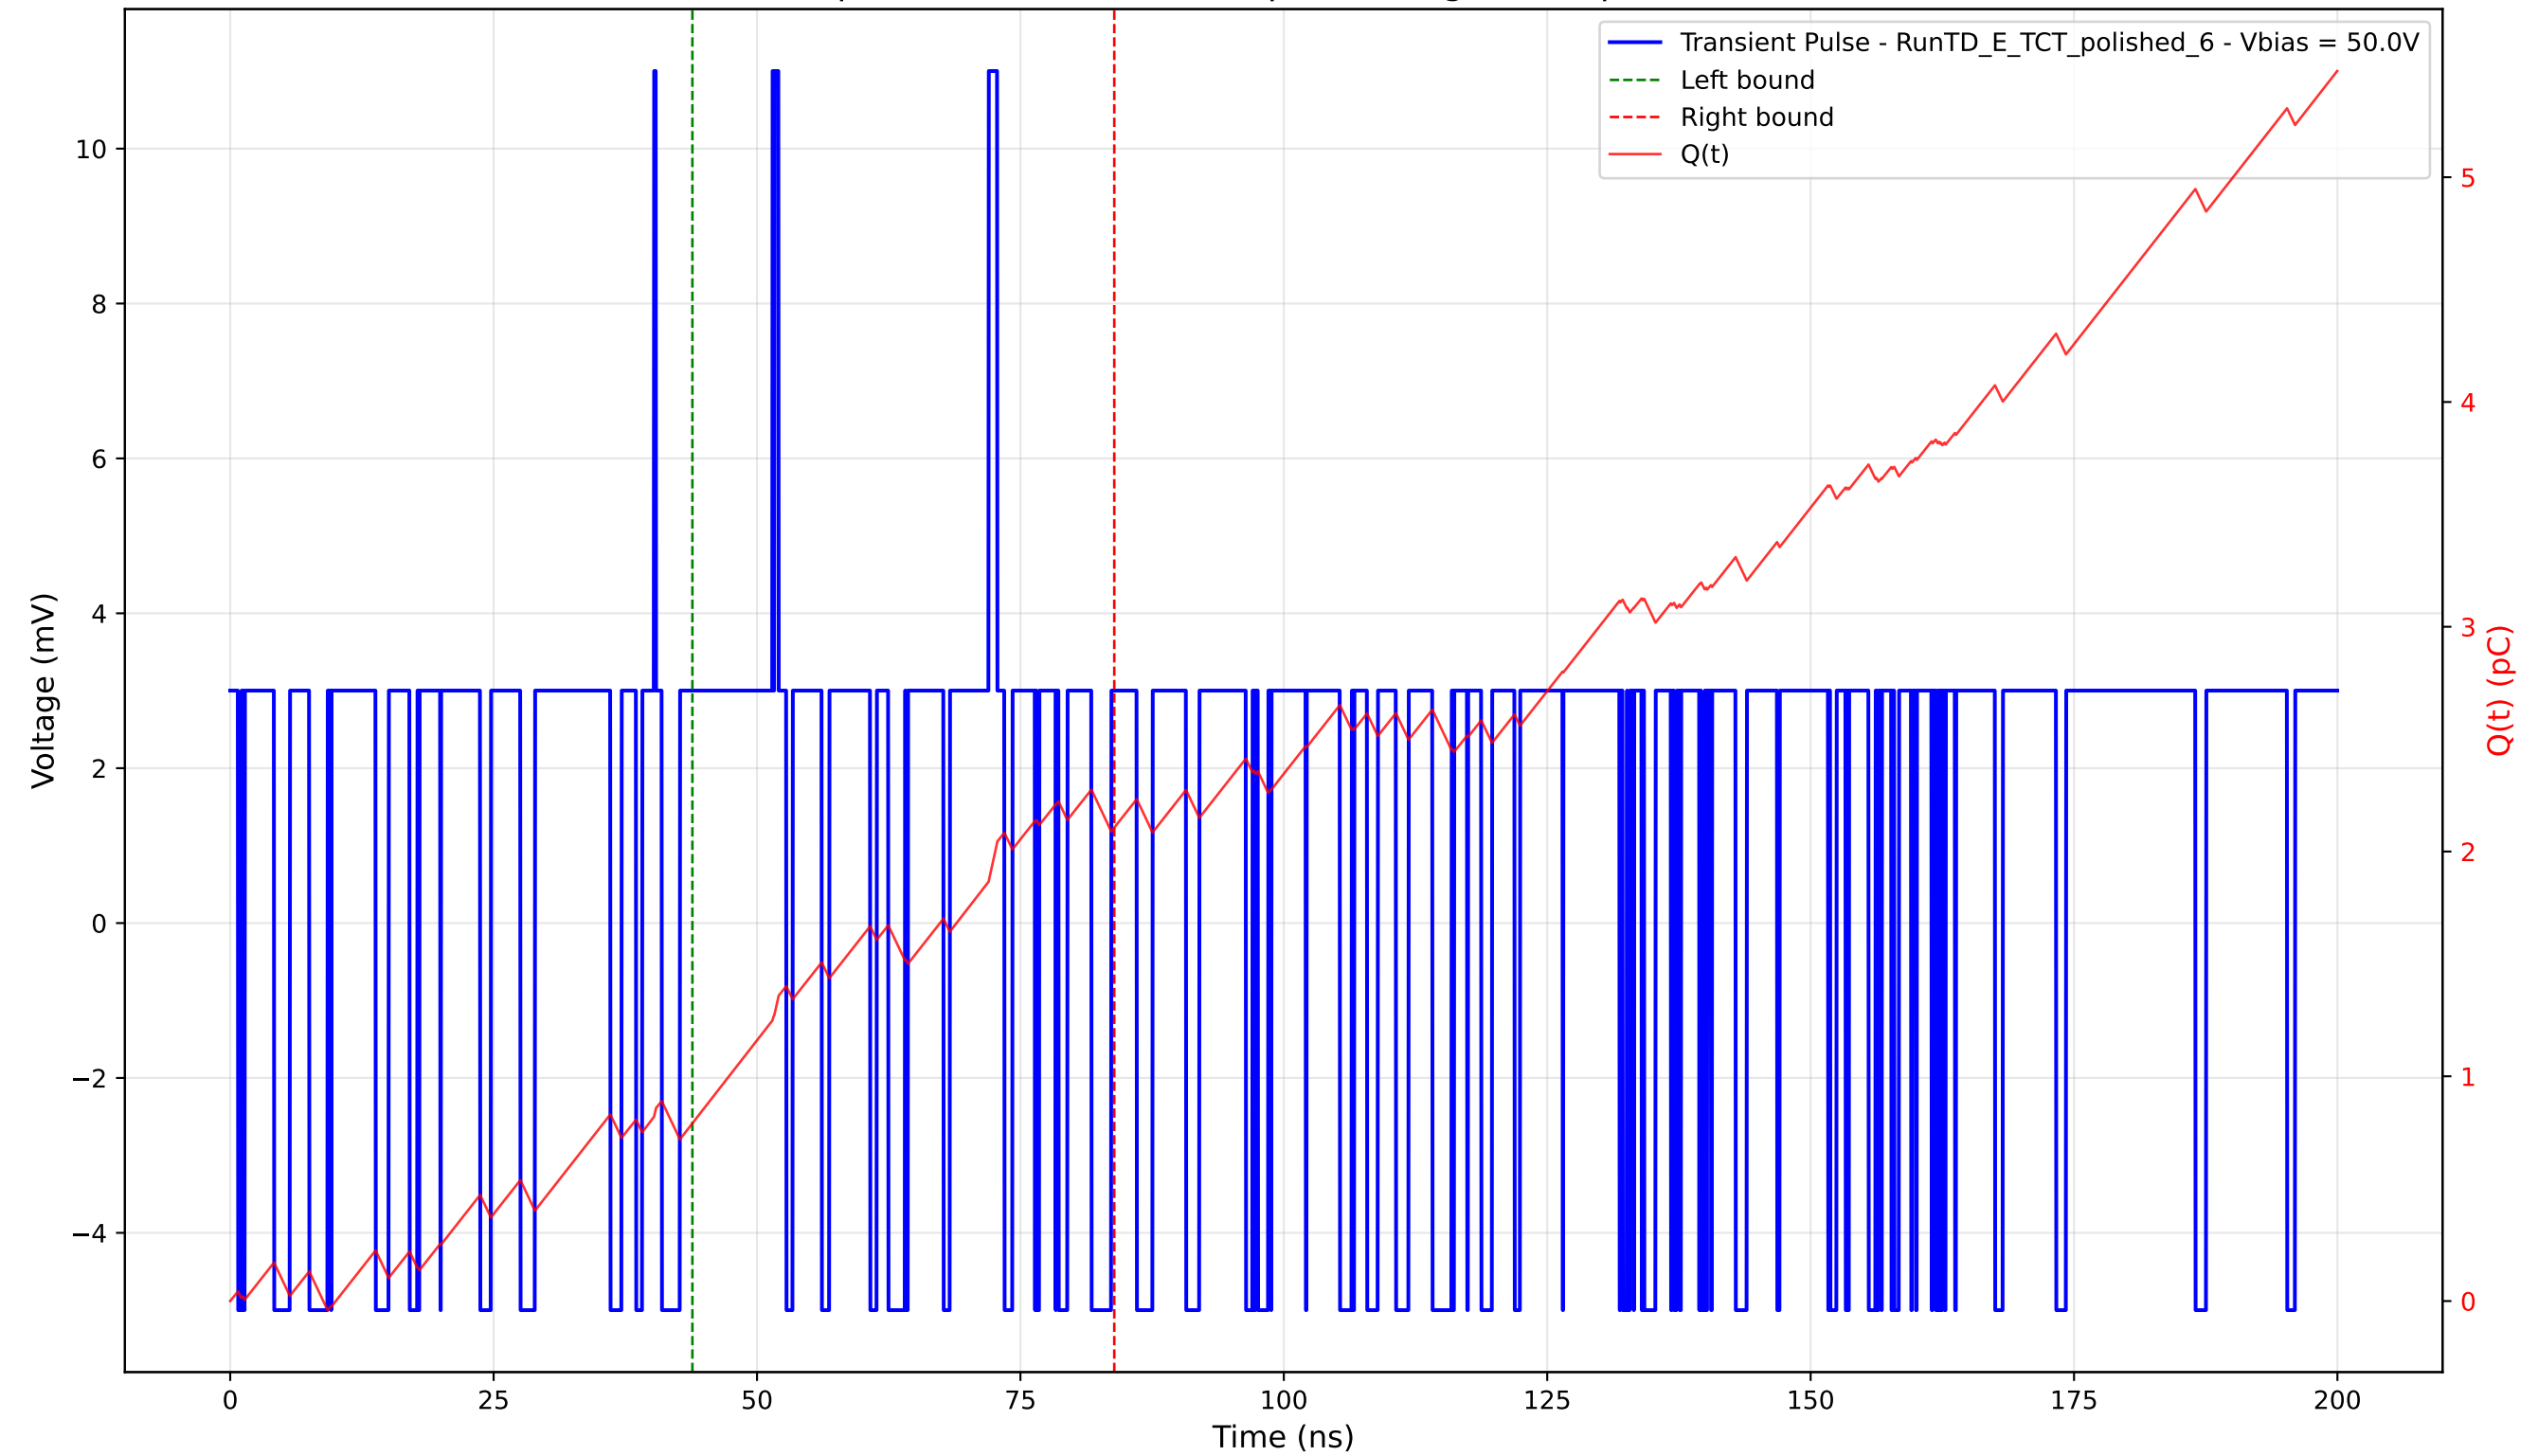


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.13 pC - Rise Time: 0.00 ns (N/A)

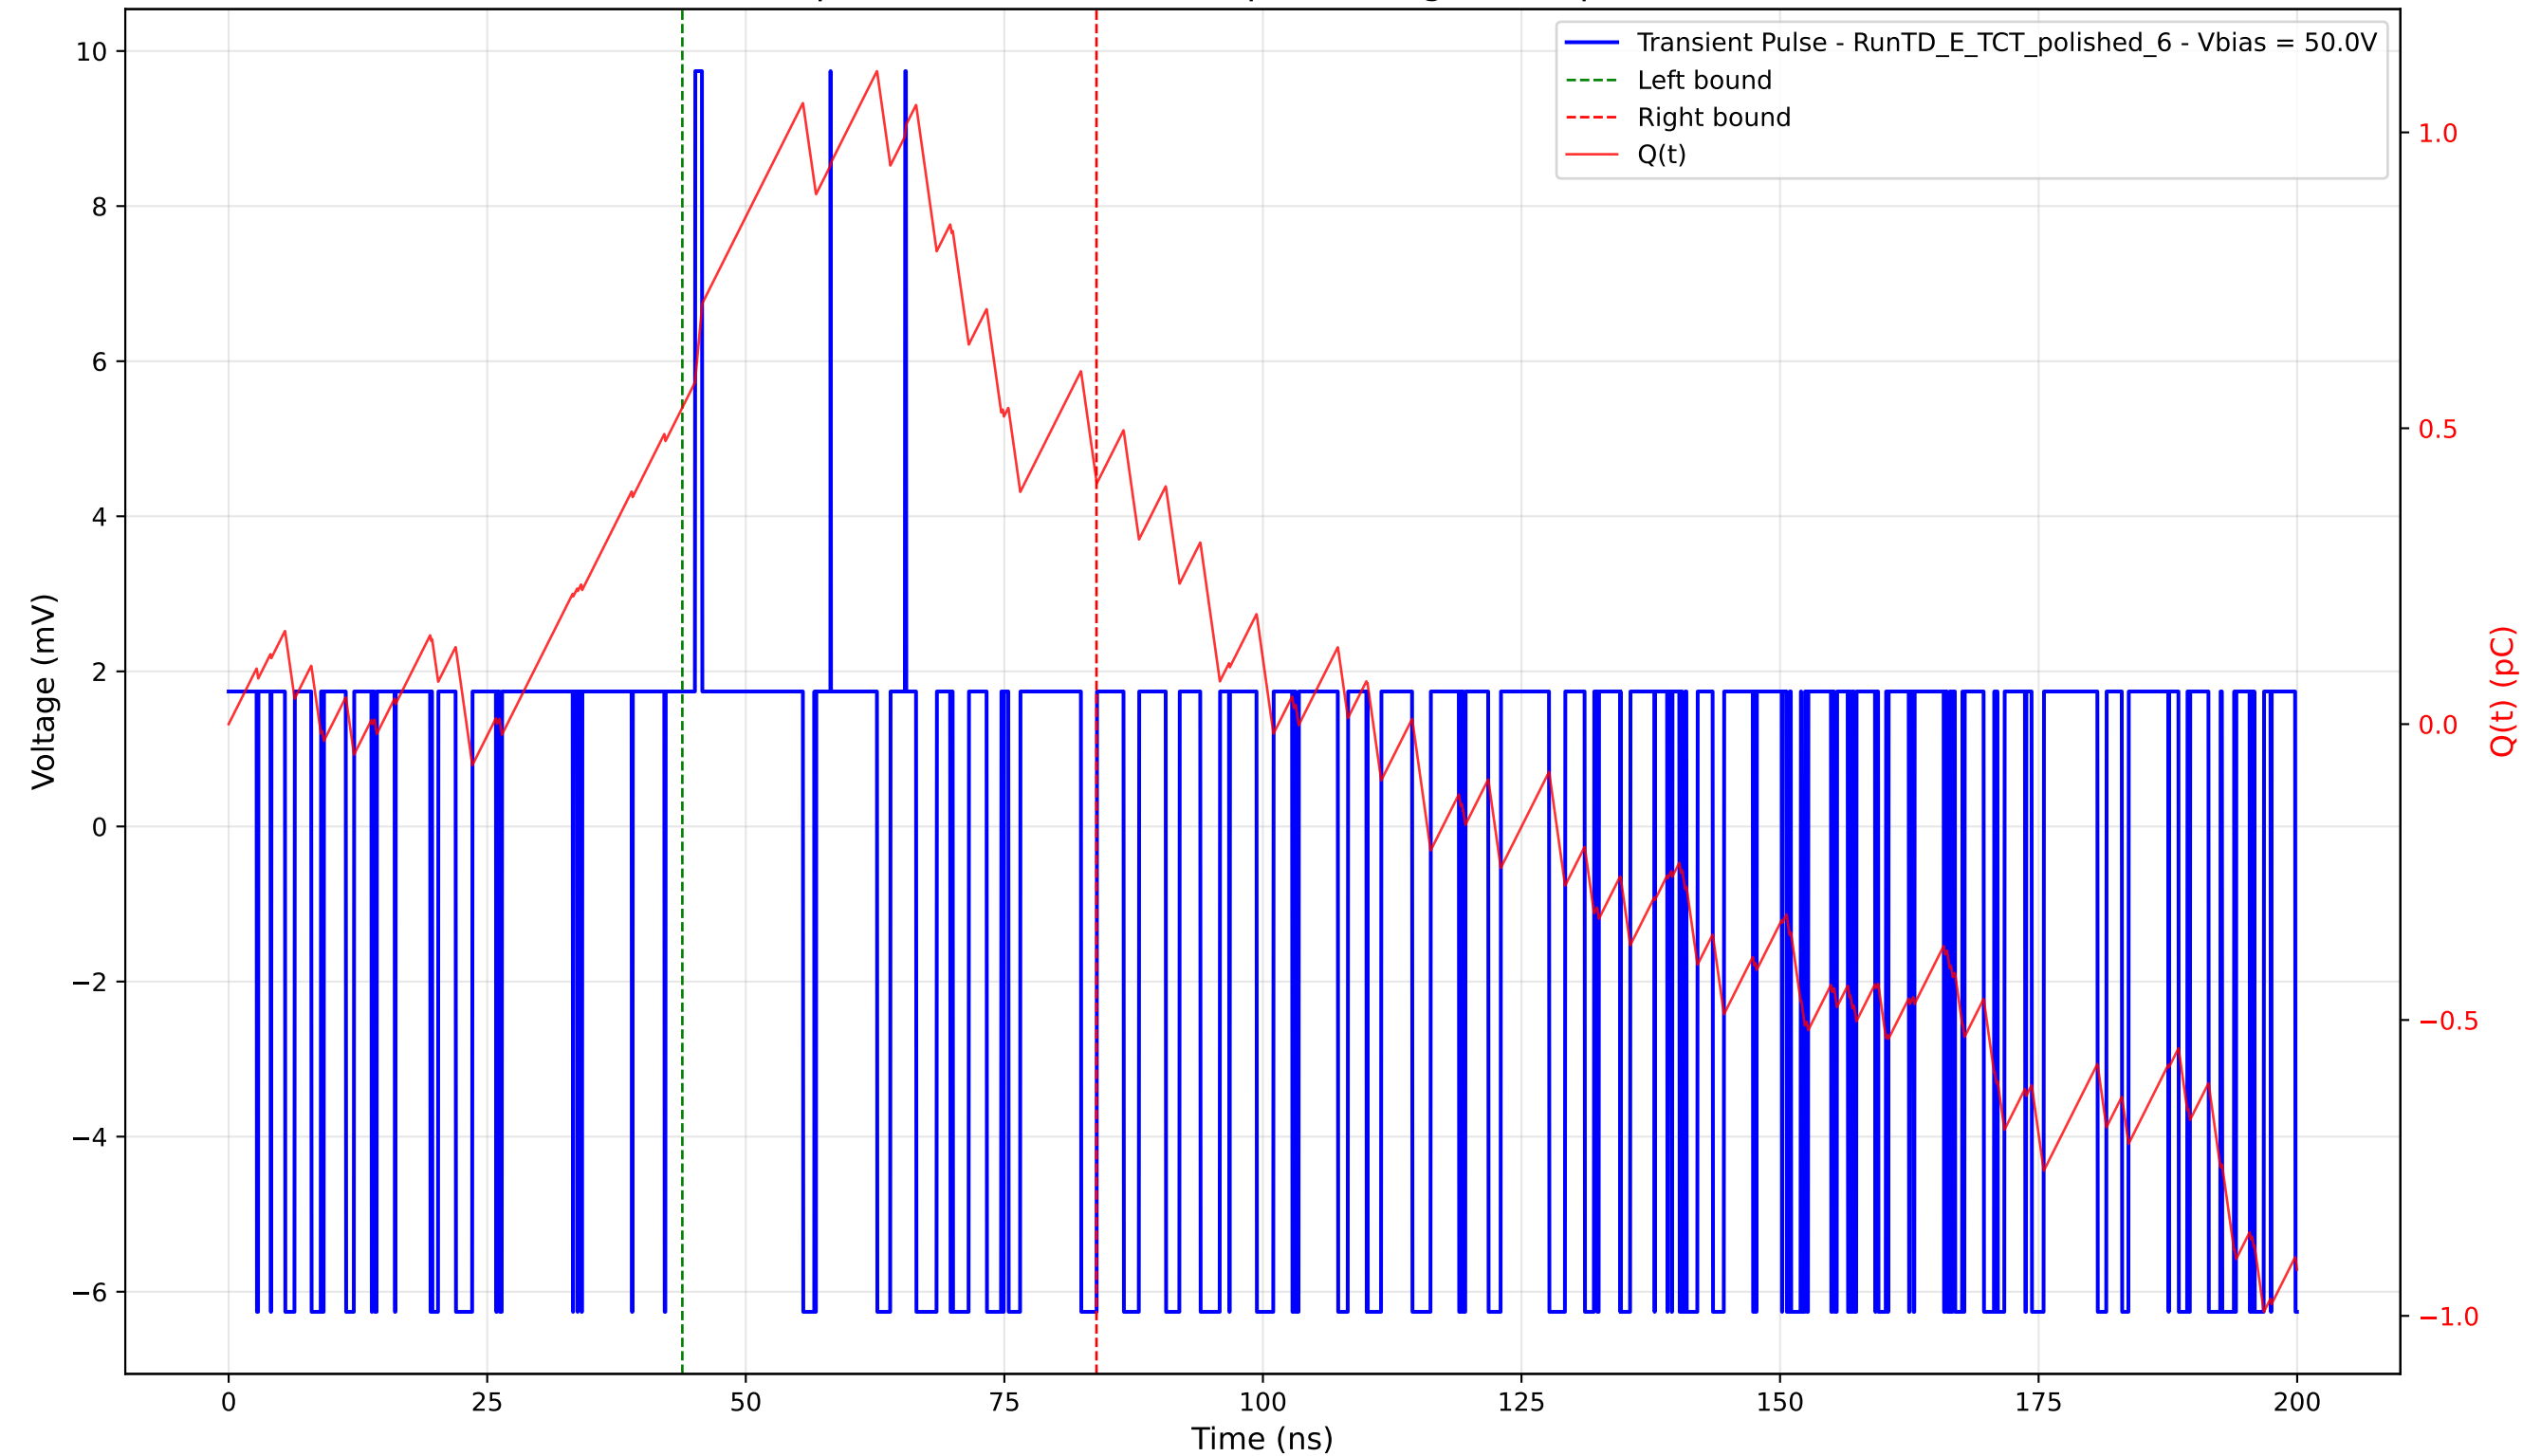


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 1.56 pC - Rise Time: 0.00 ns (N/A)

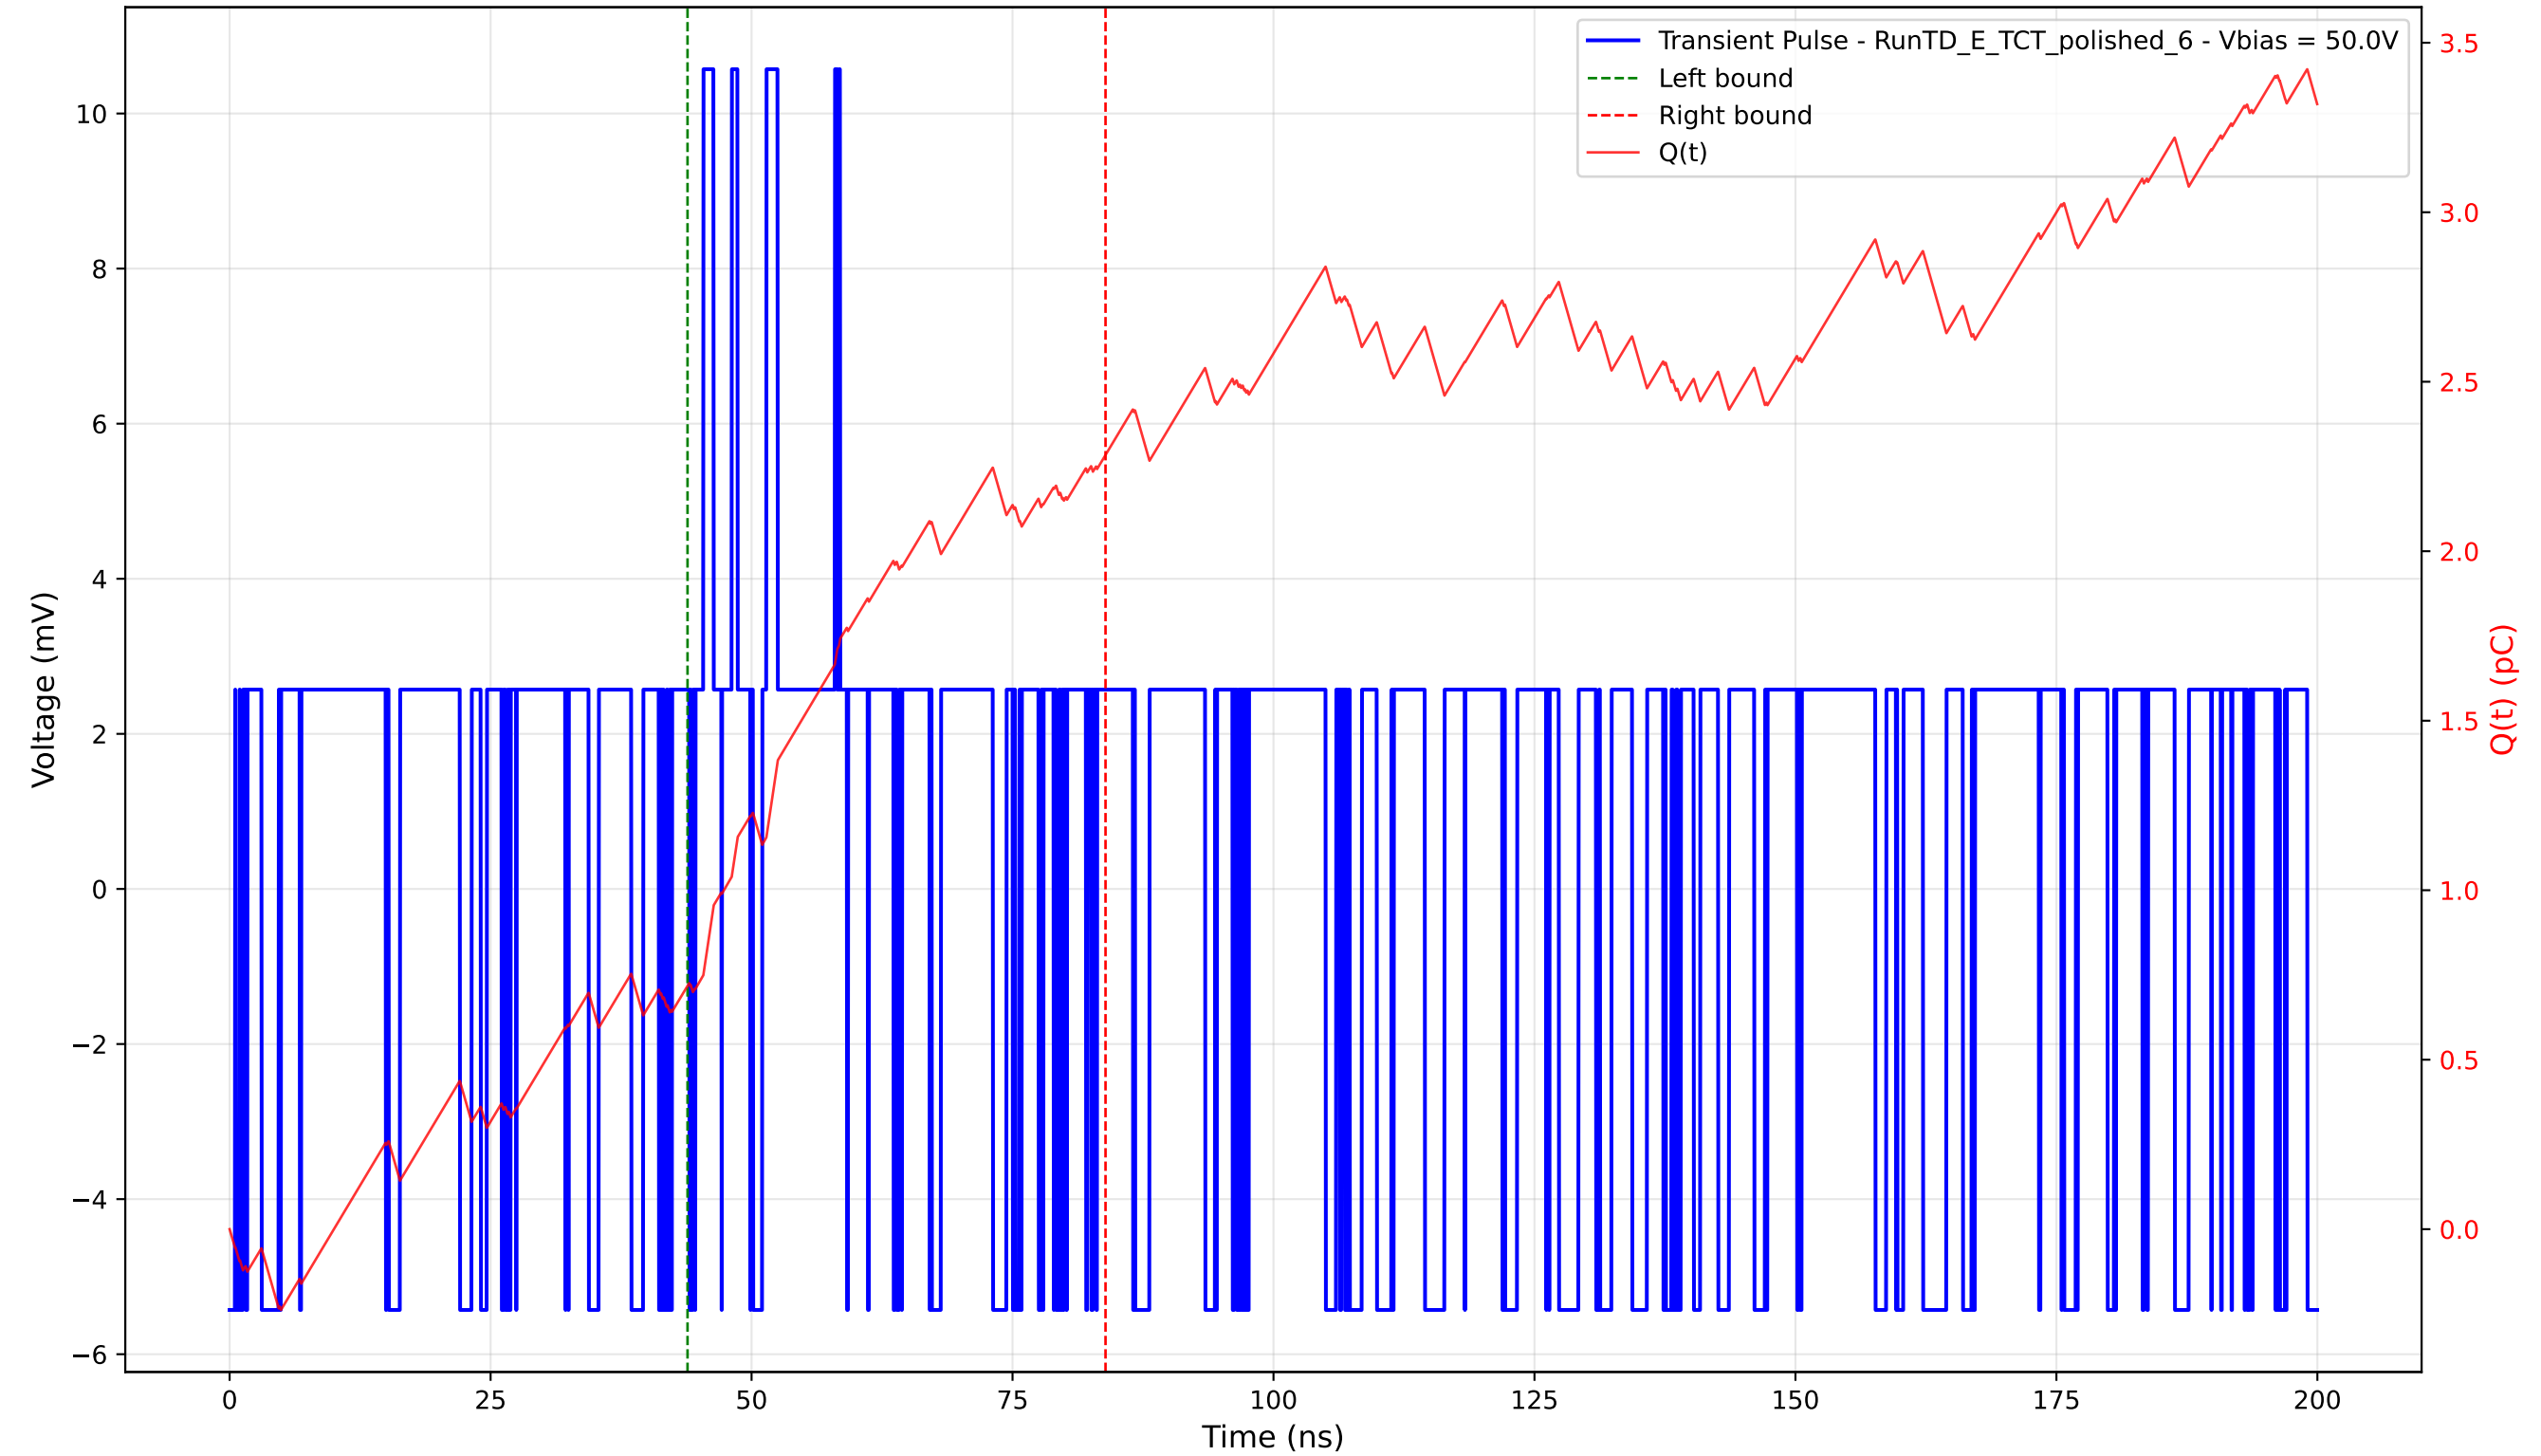


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 1.25 pC - Rise Time: 0.00 ns (N/A)

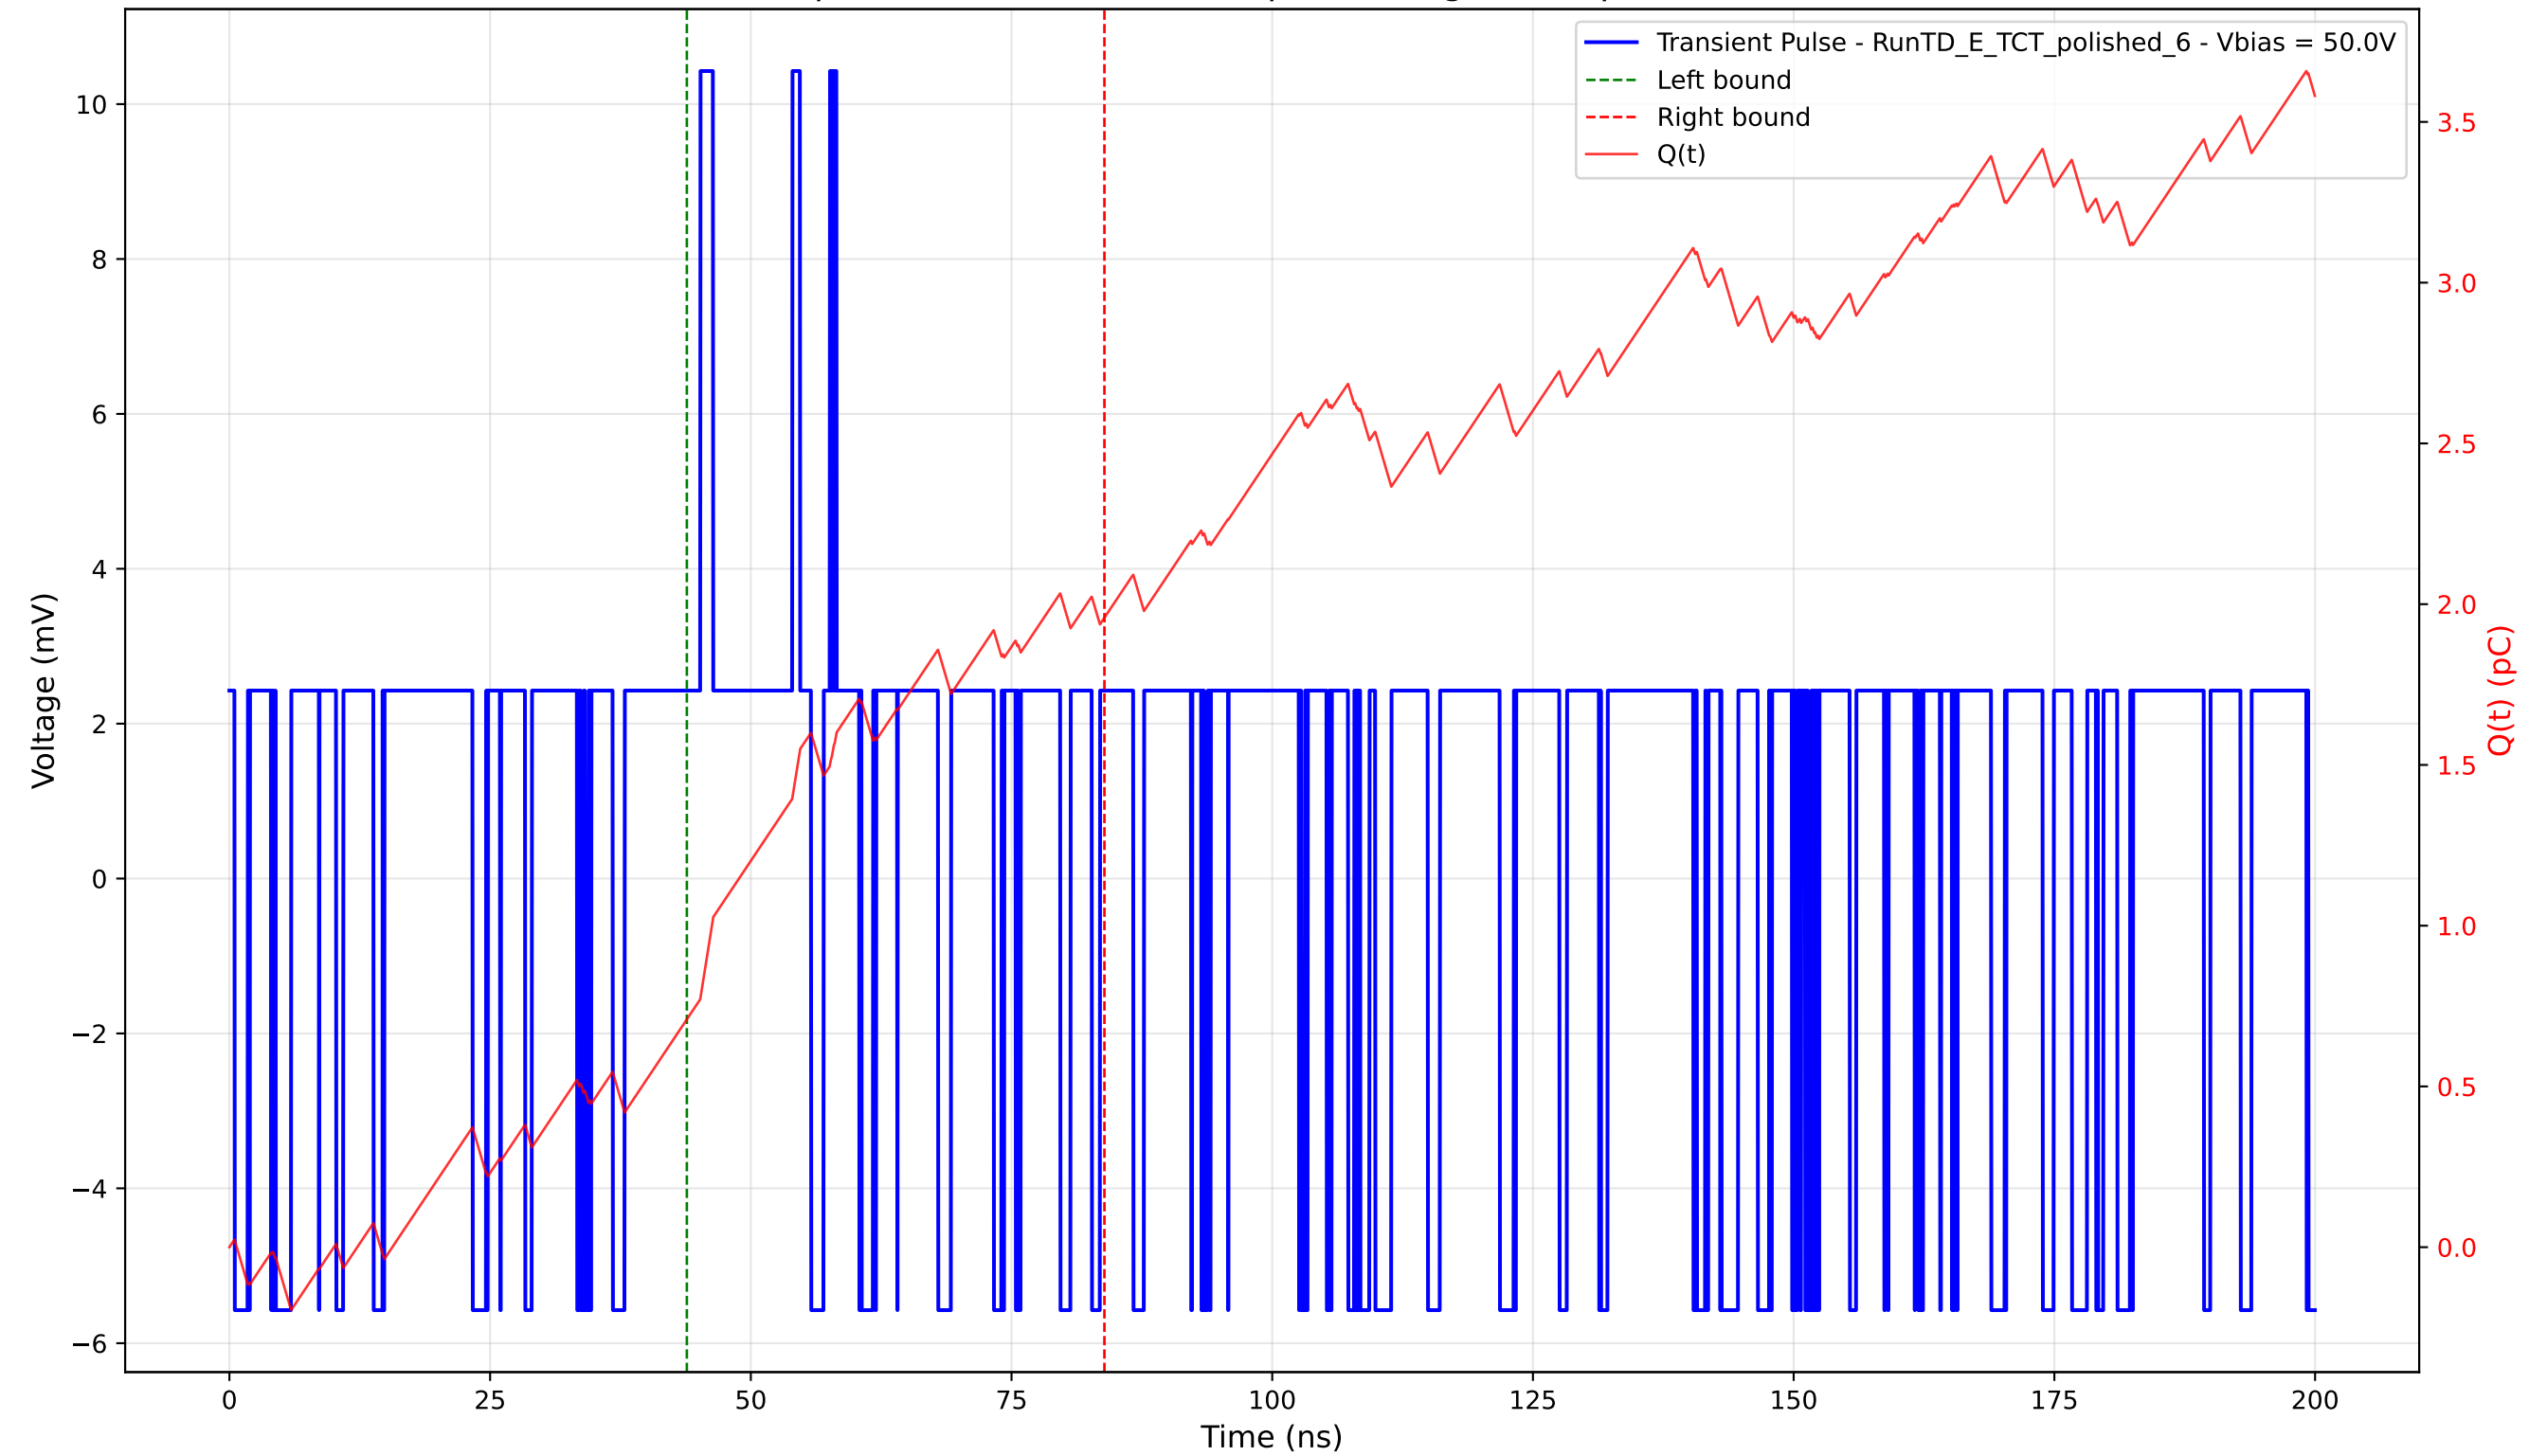


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.91 pC - Rise Time: 0.00 ns (N/A)

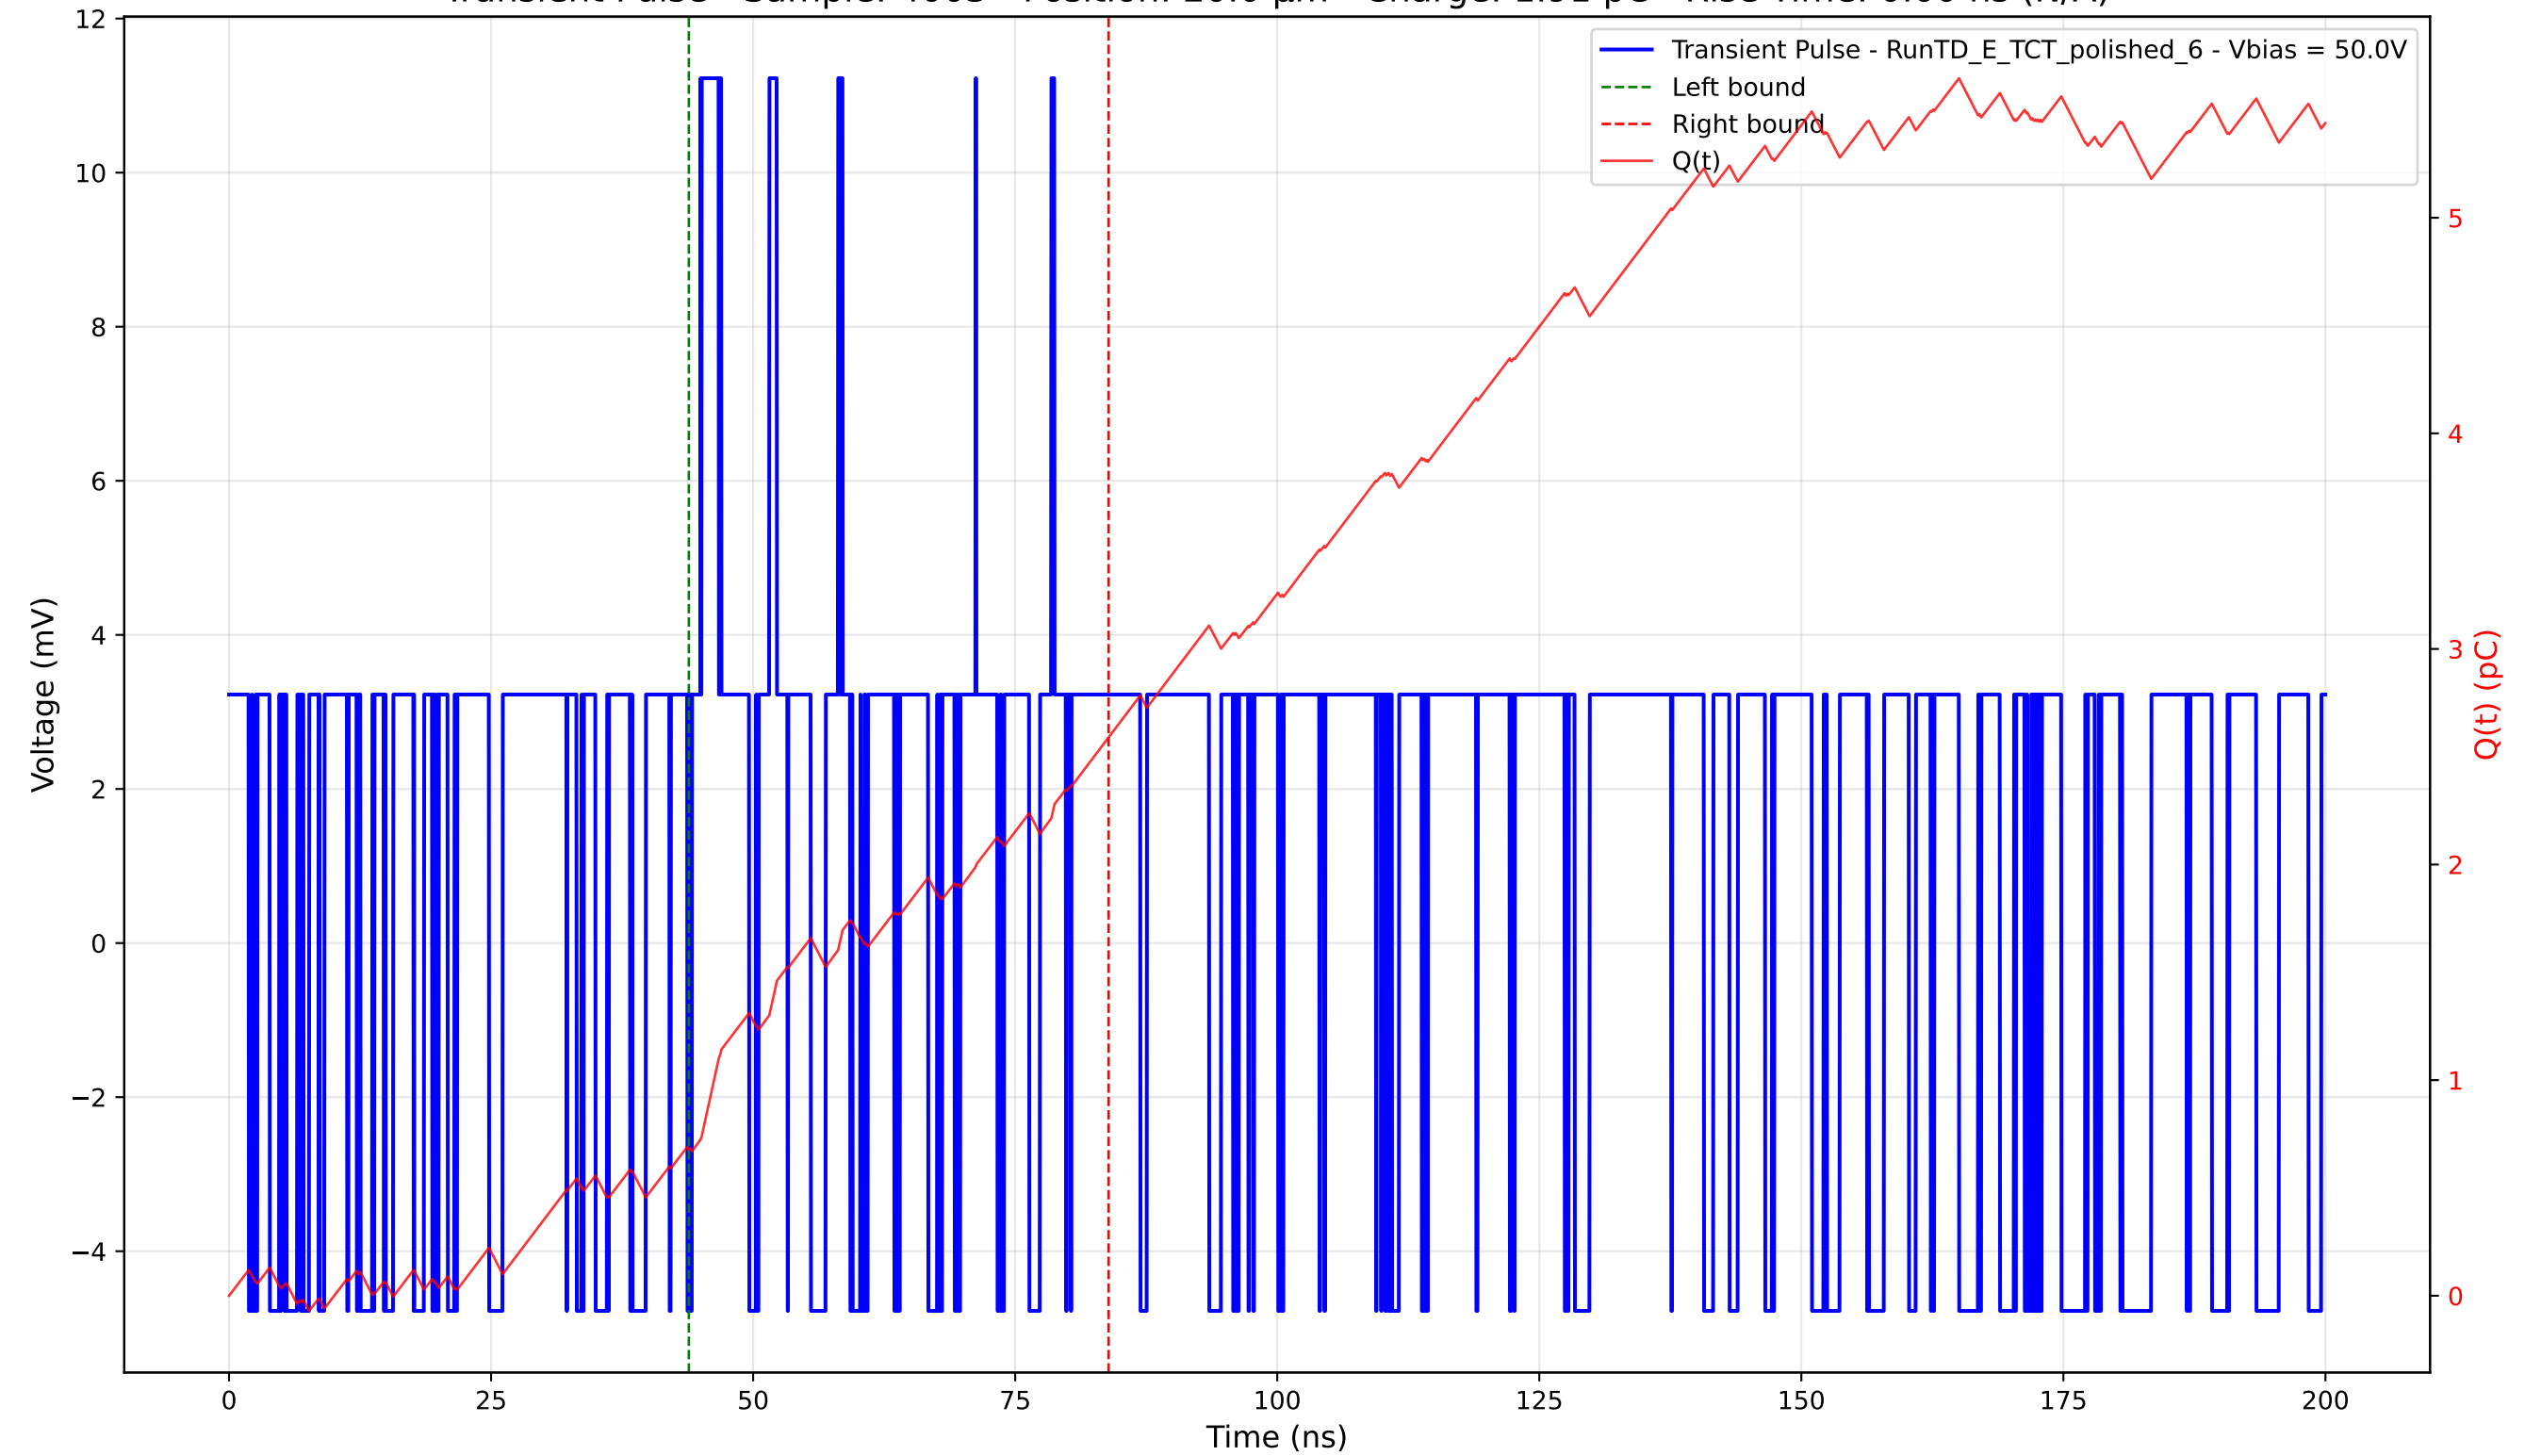


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 0.93 pC - Rise Time: 0.54 ns

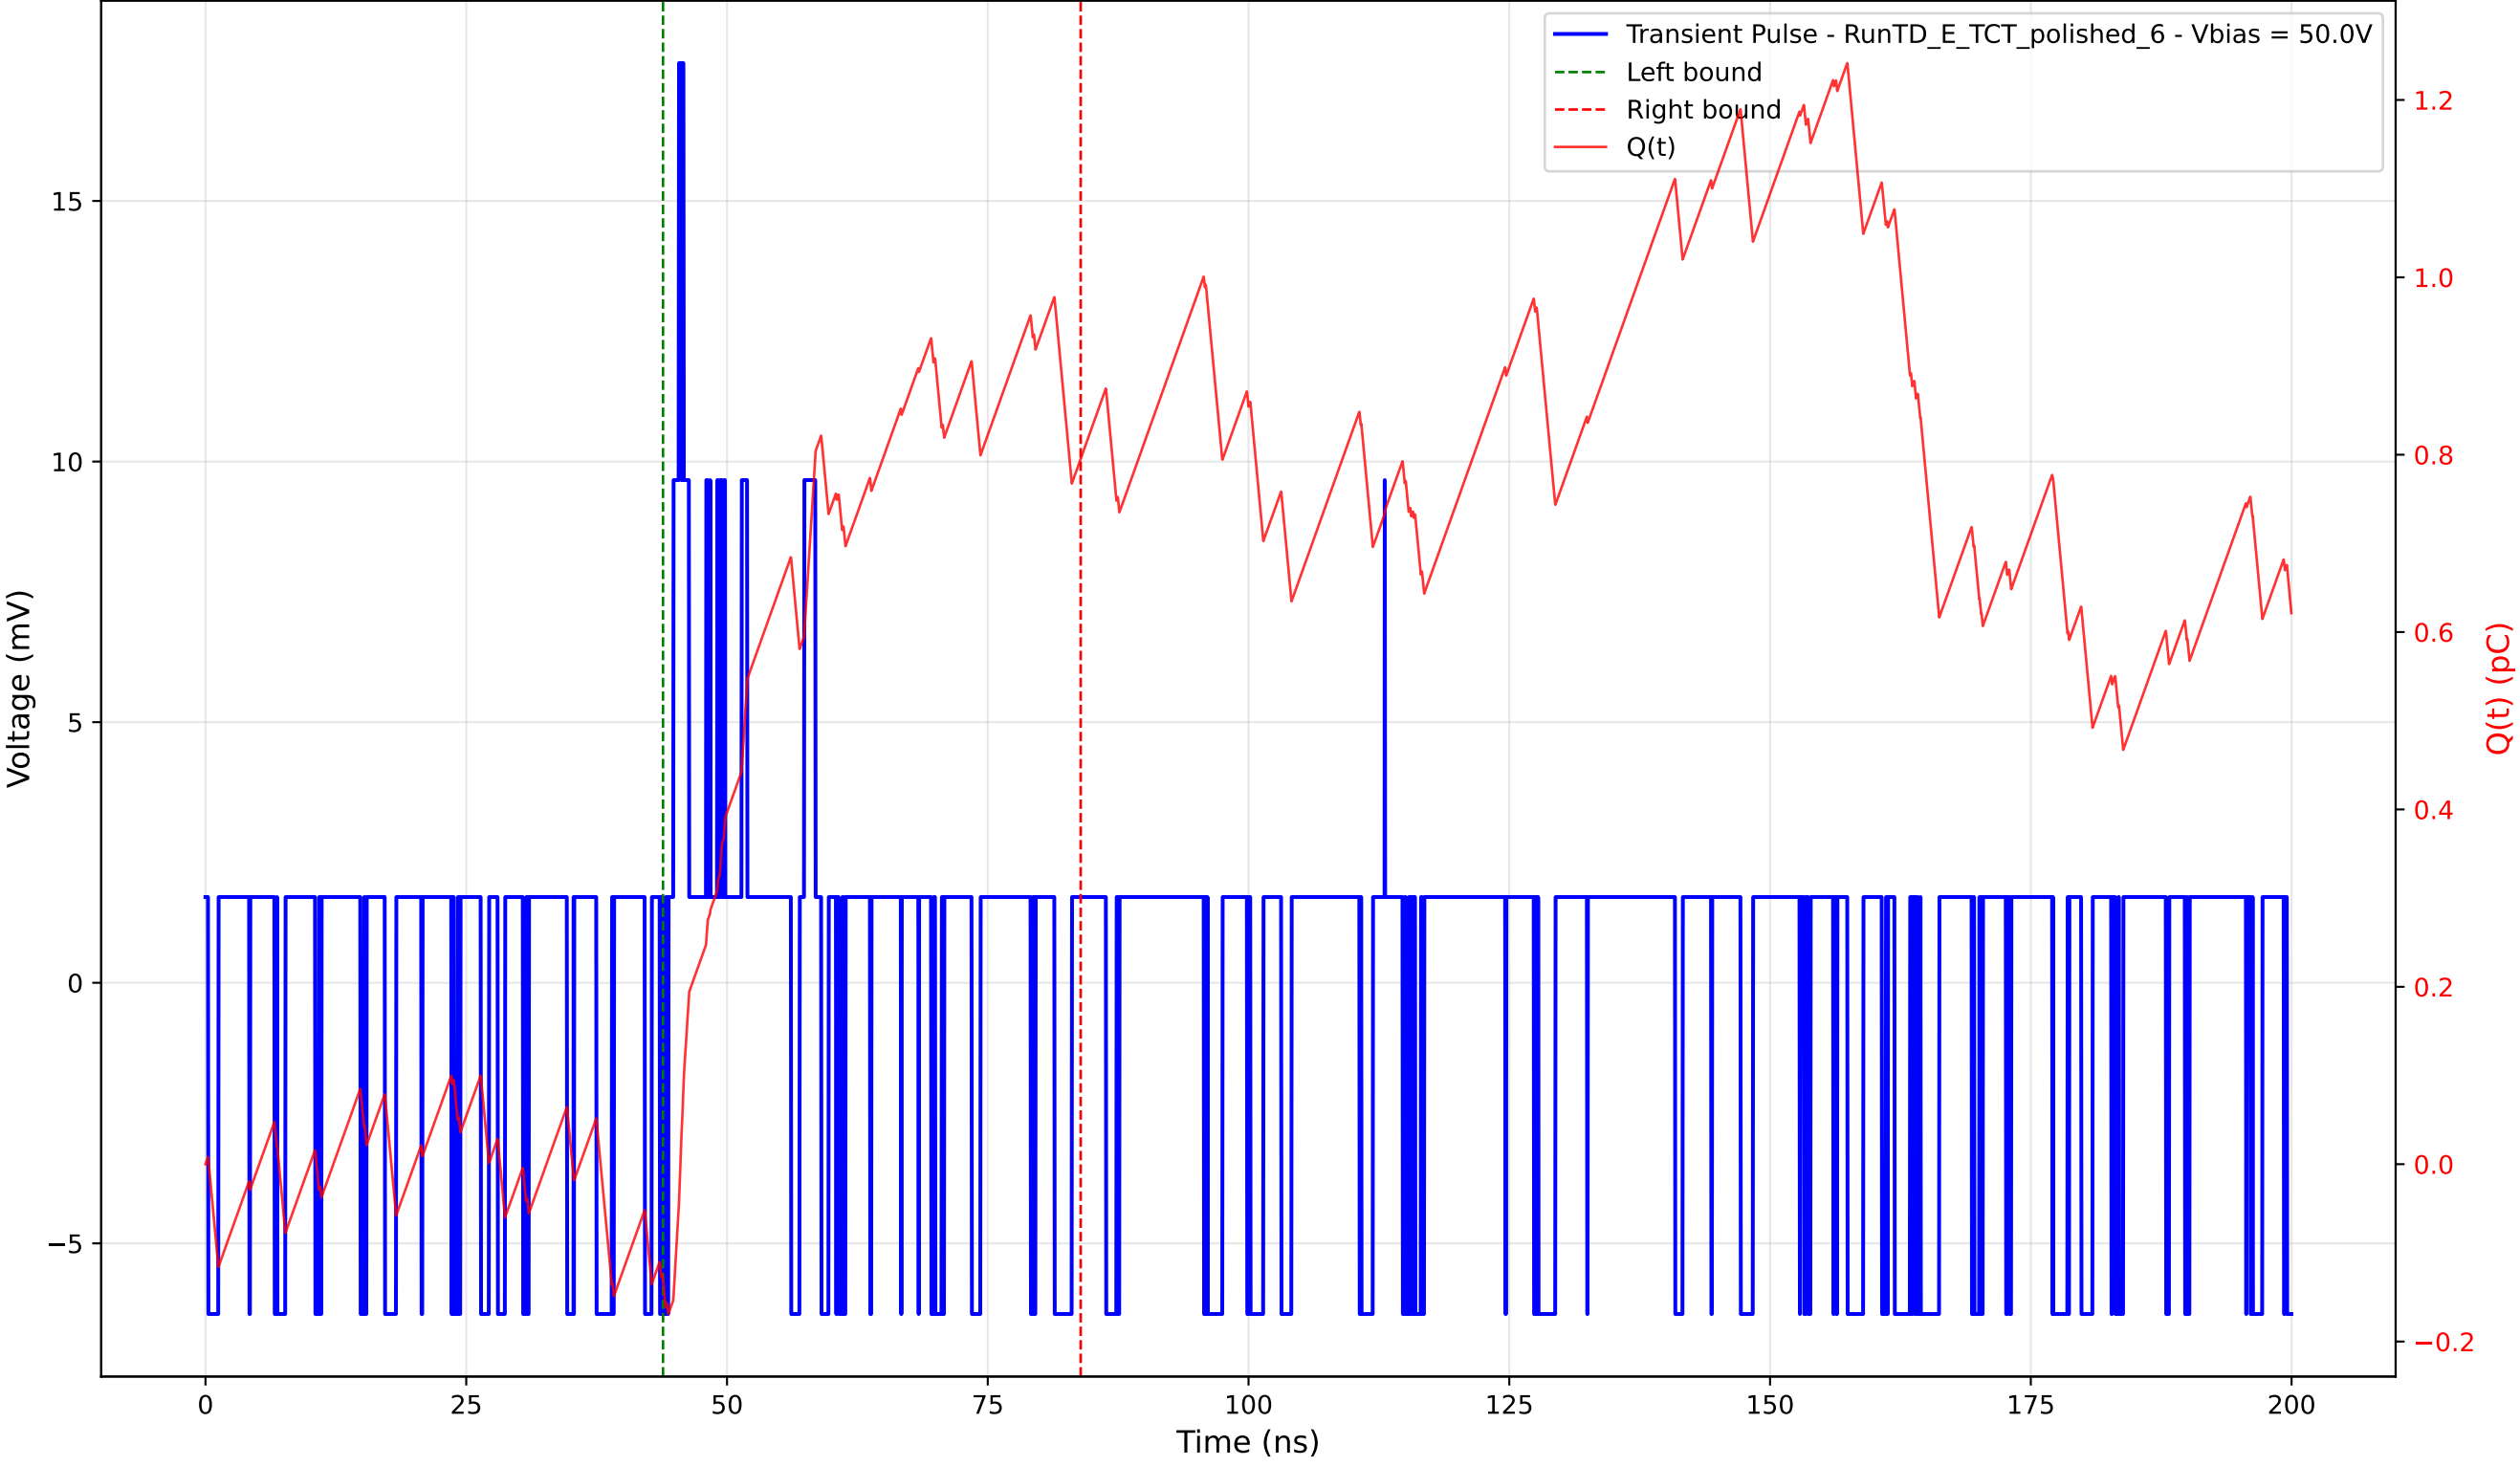


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 0.01 pC - Rise Time: 0.72 ns

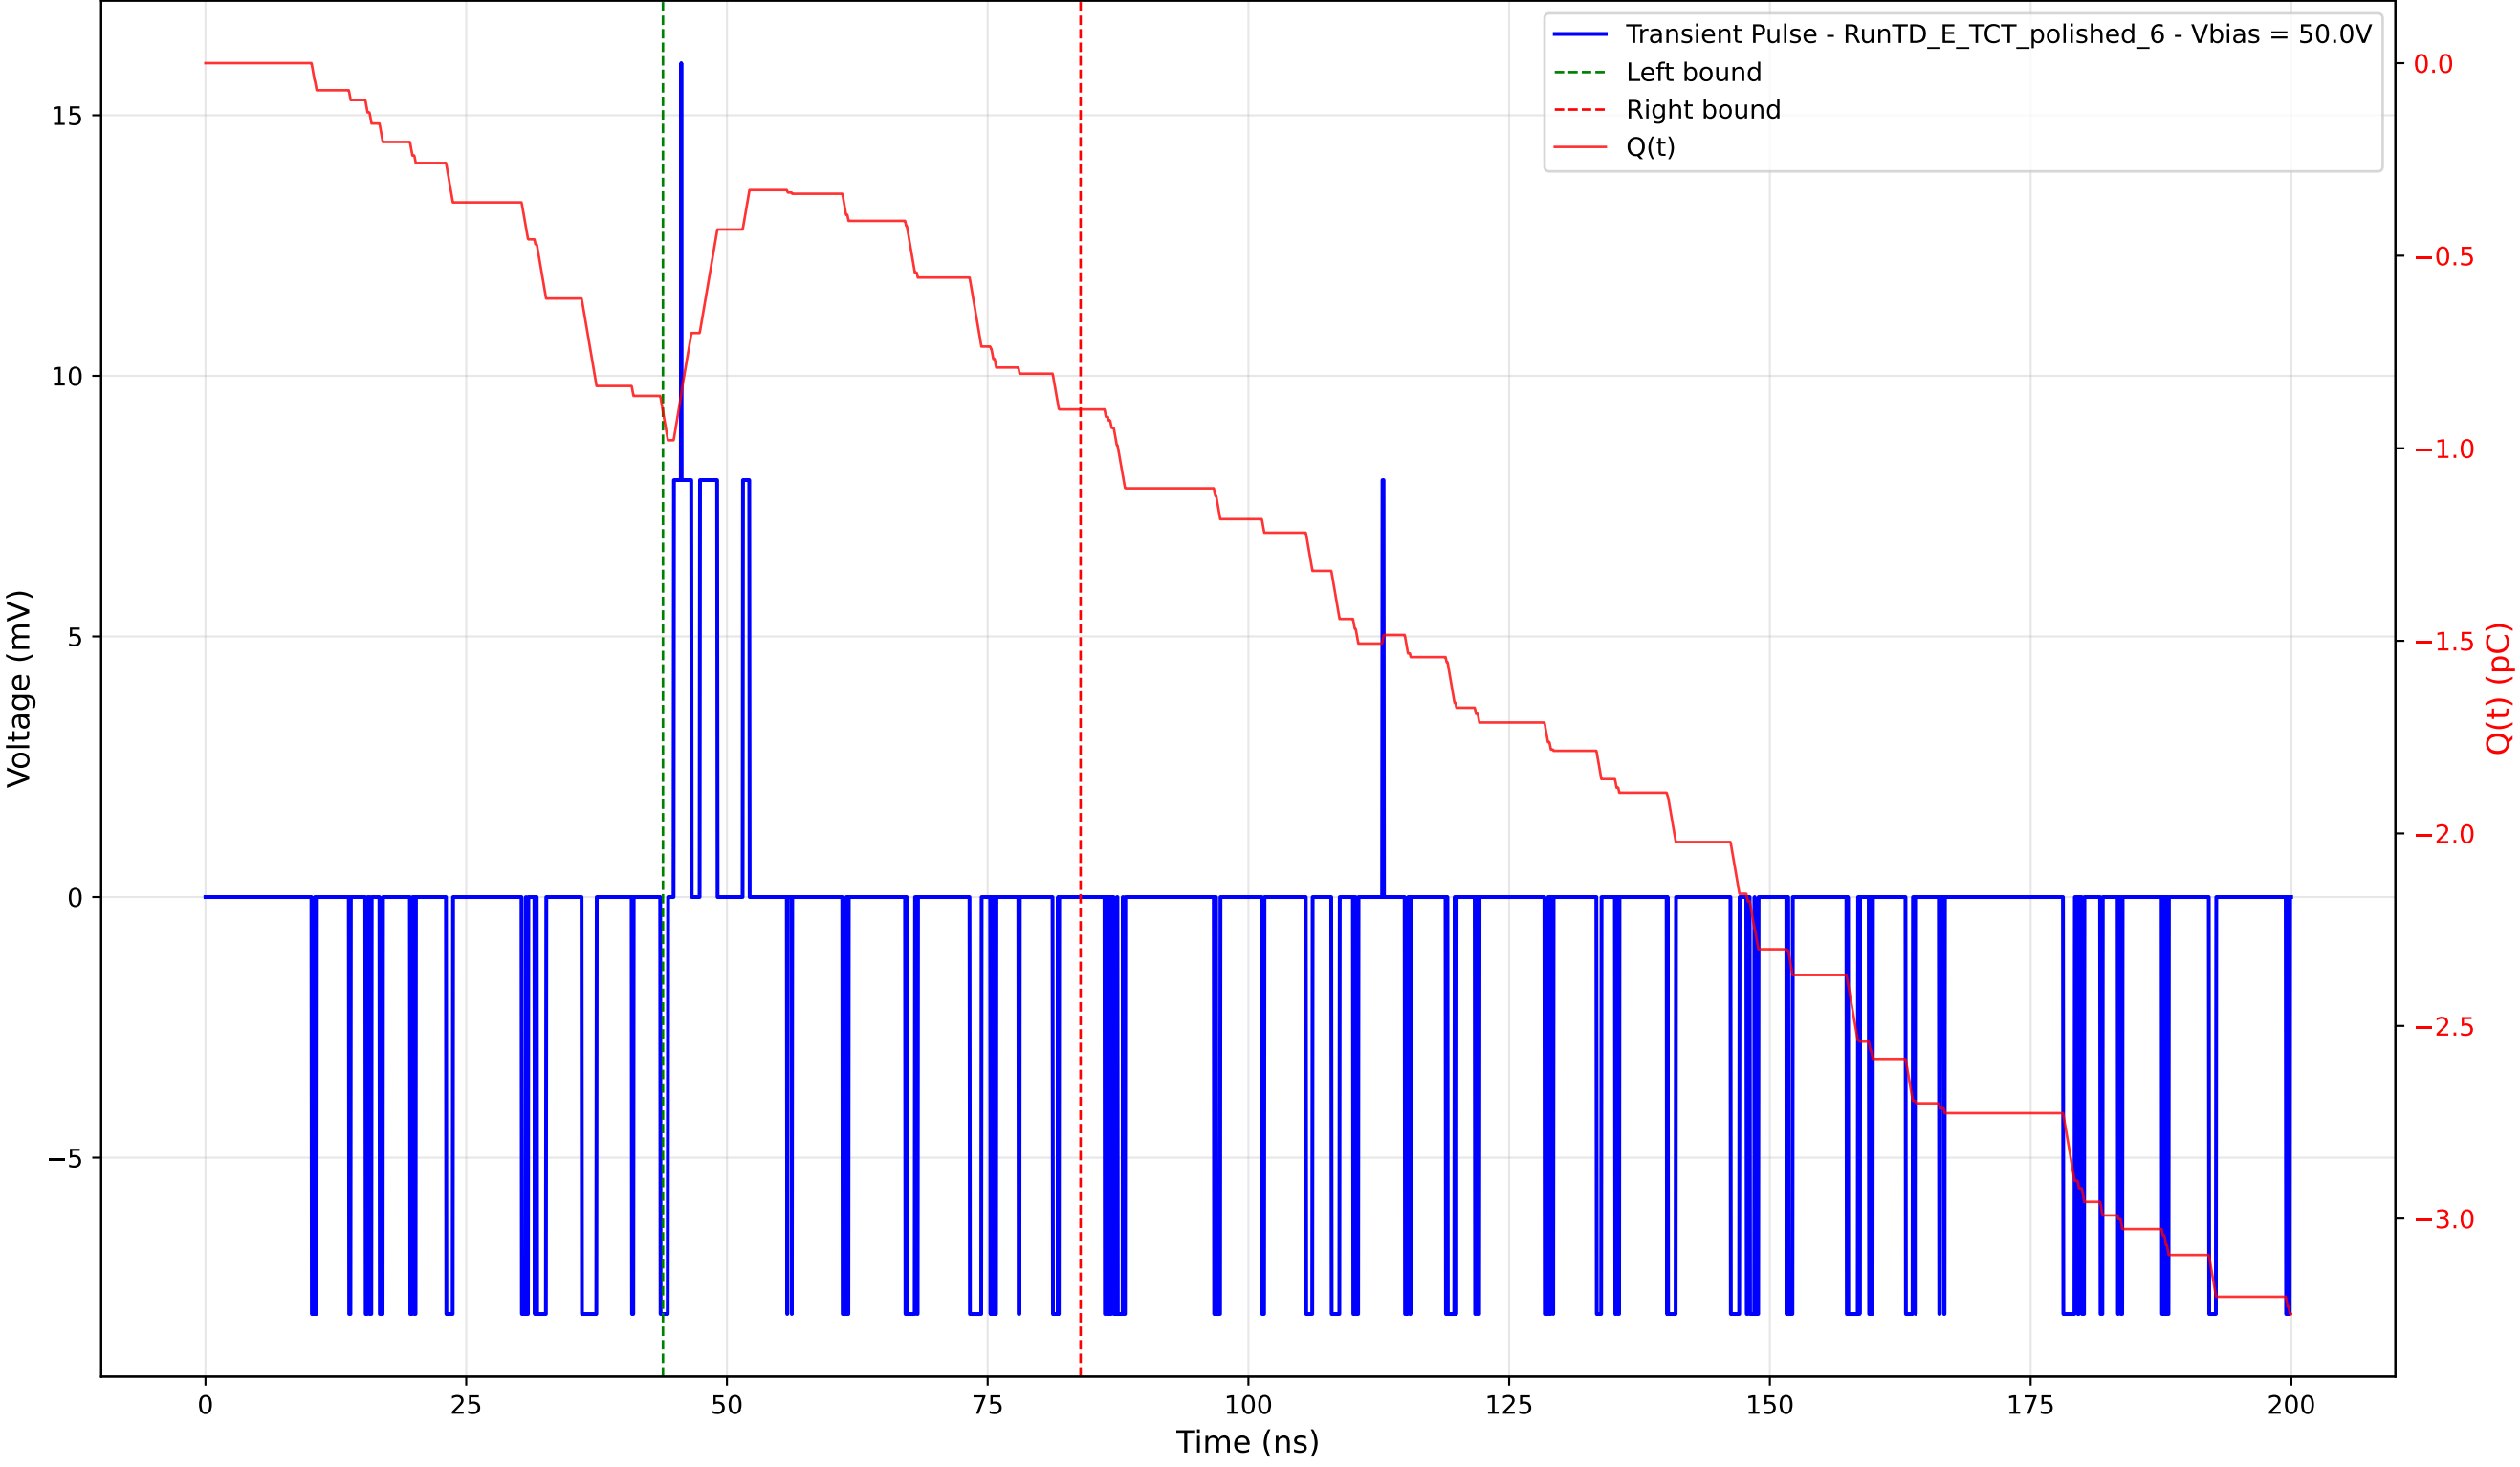


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.32 pC - Rise Time: 0.56 ns

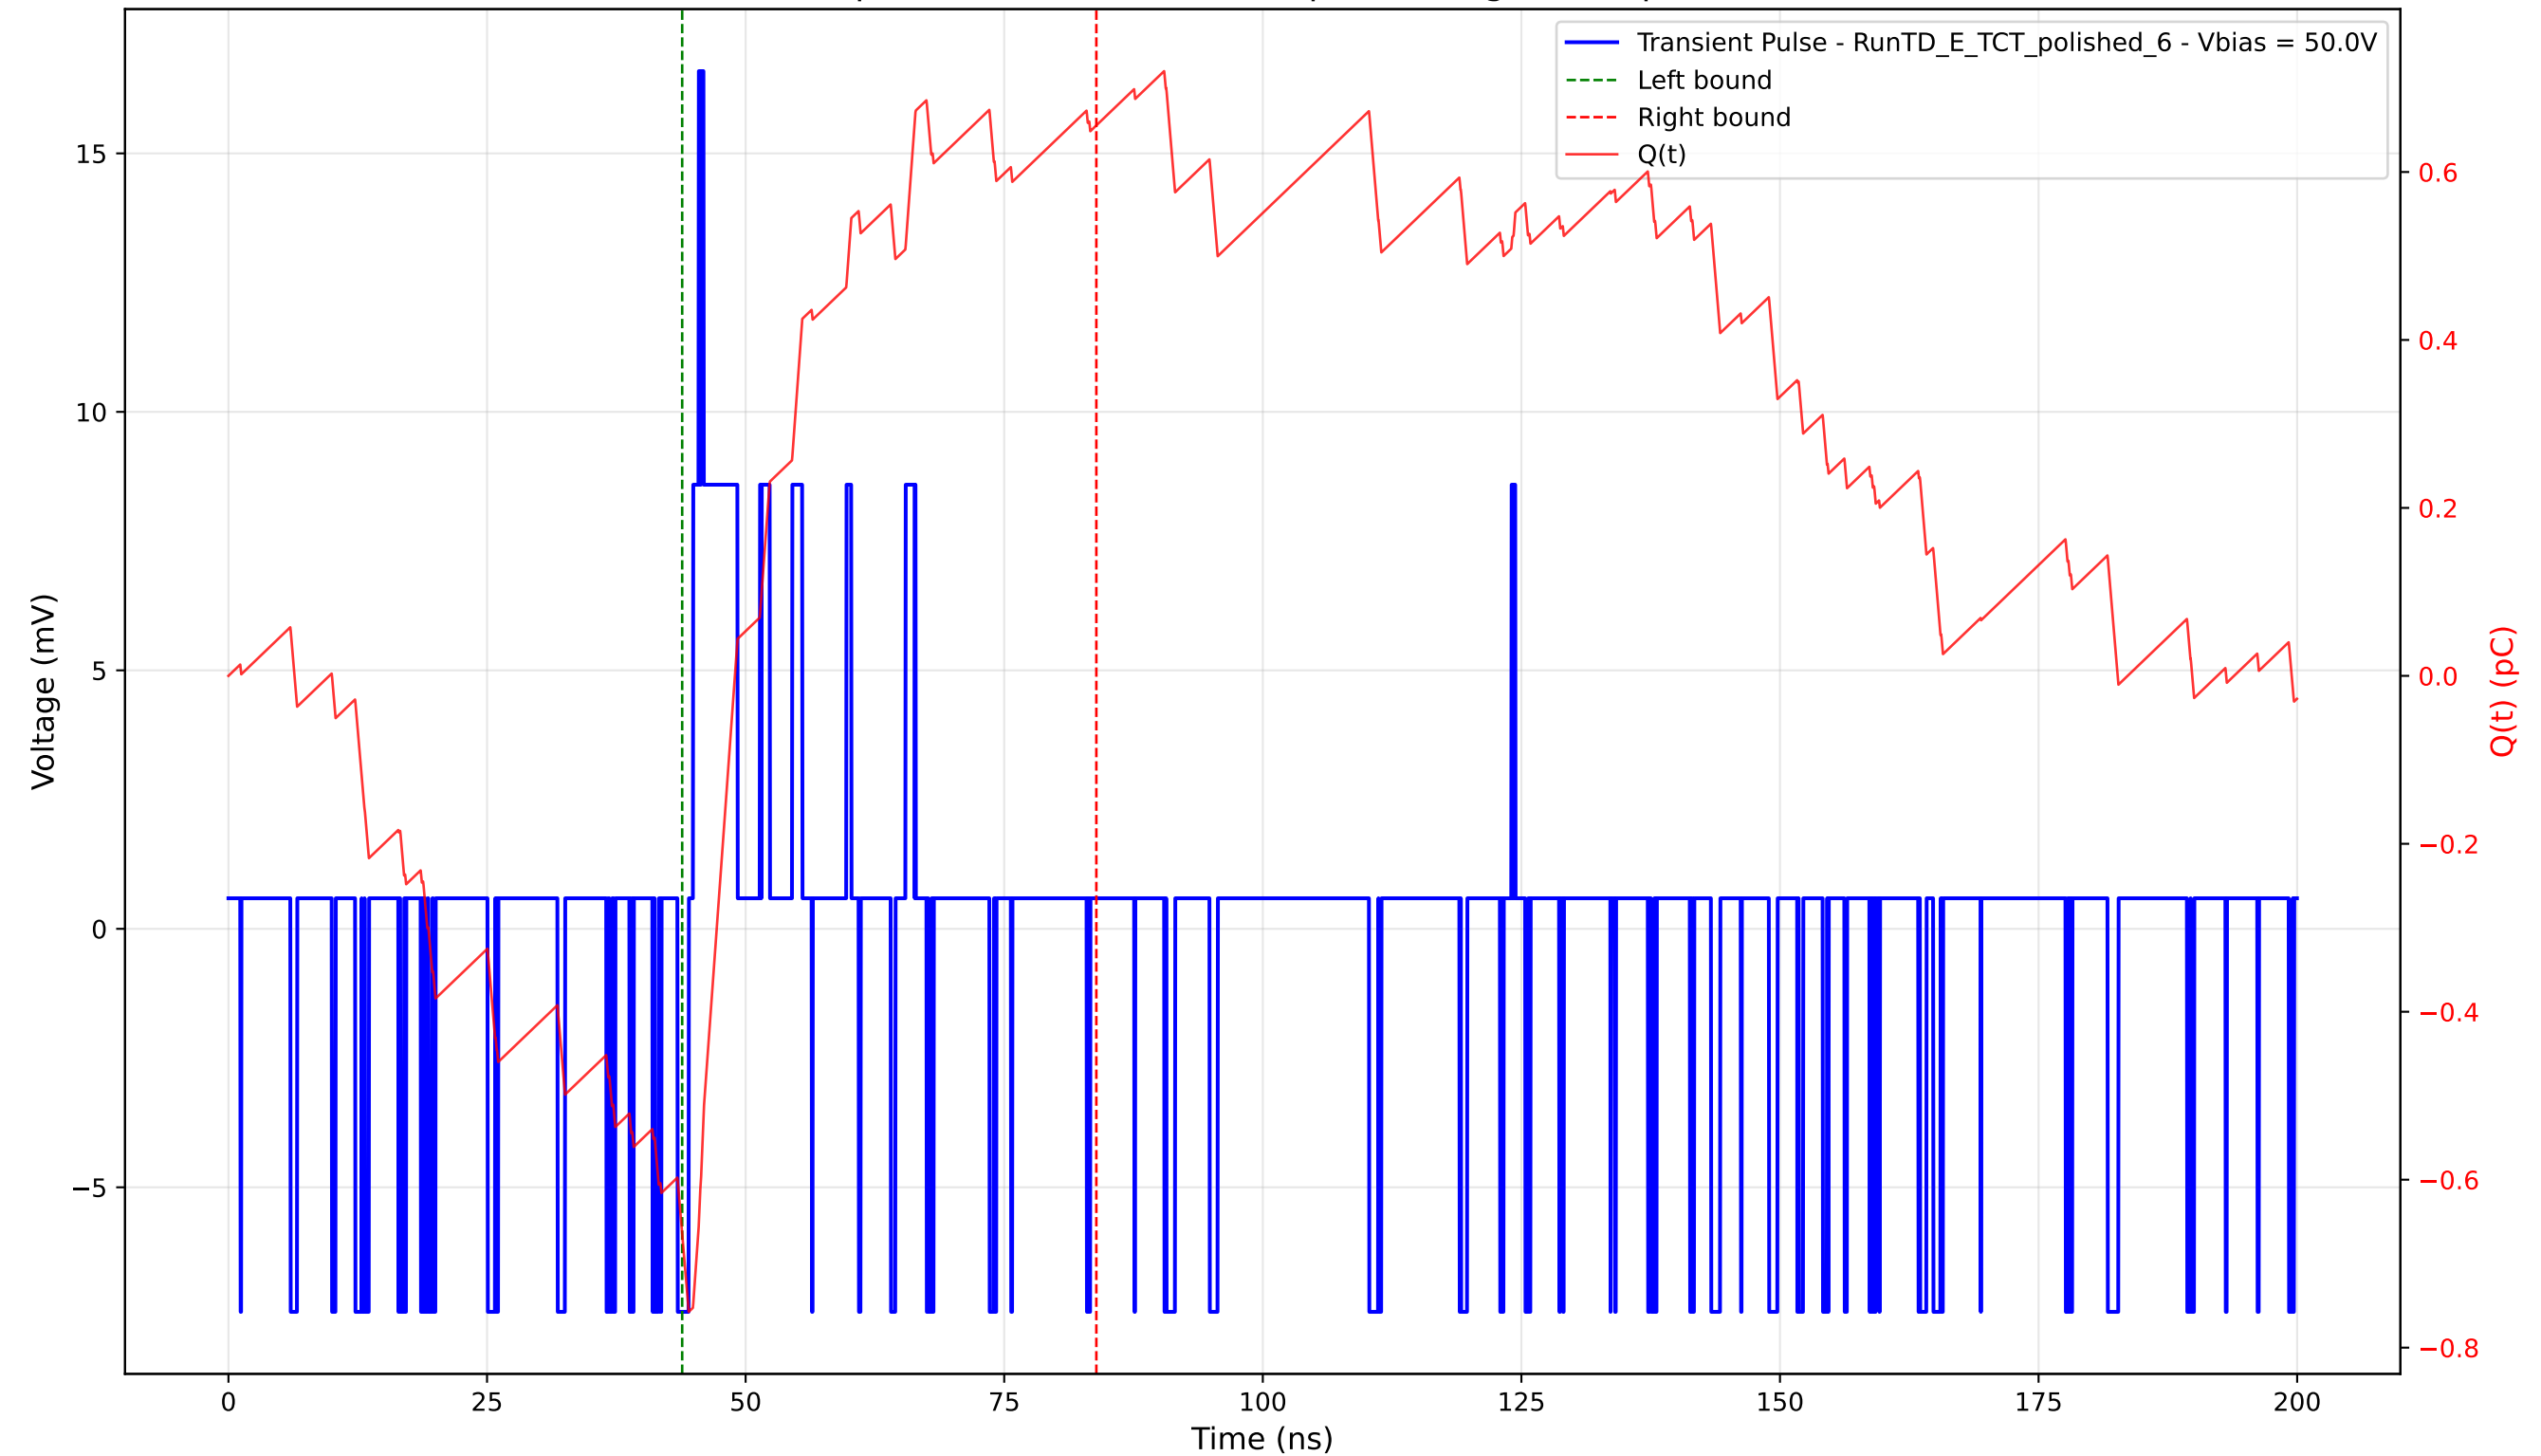


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 2.40 pC - Rise Time: 0.44 ns

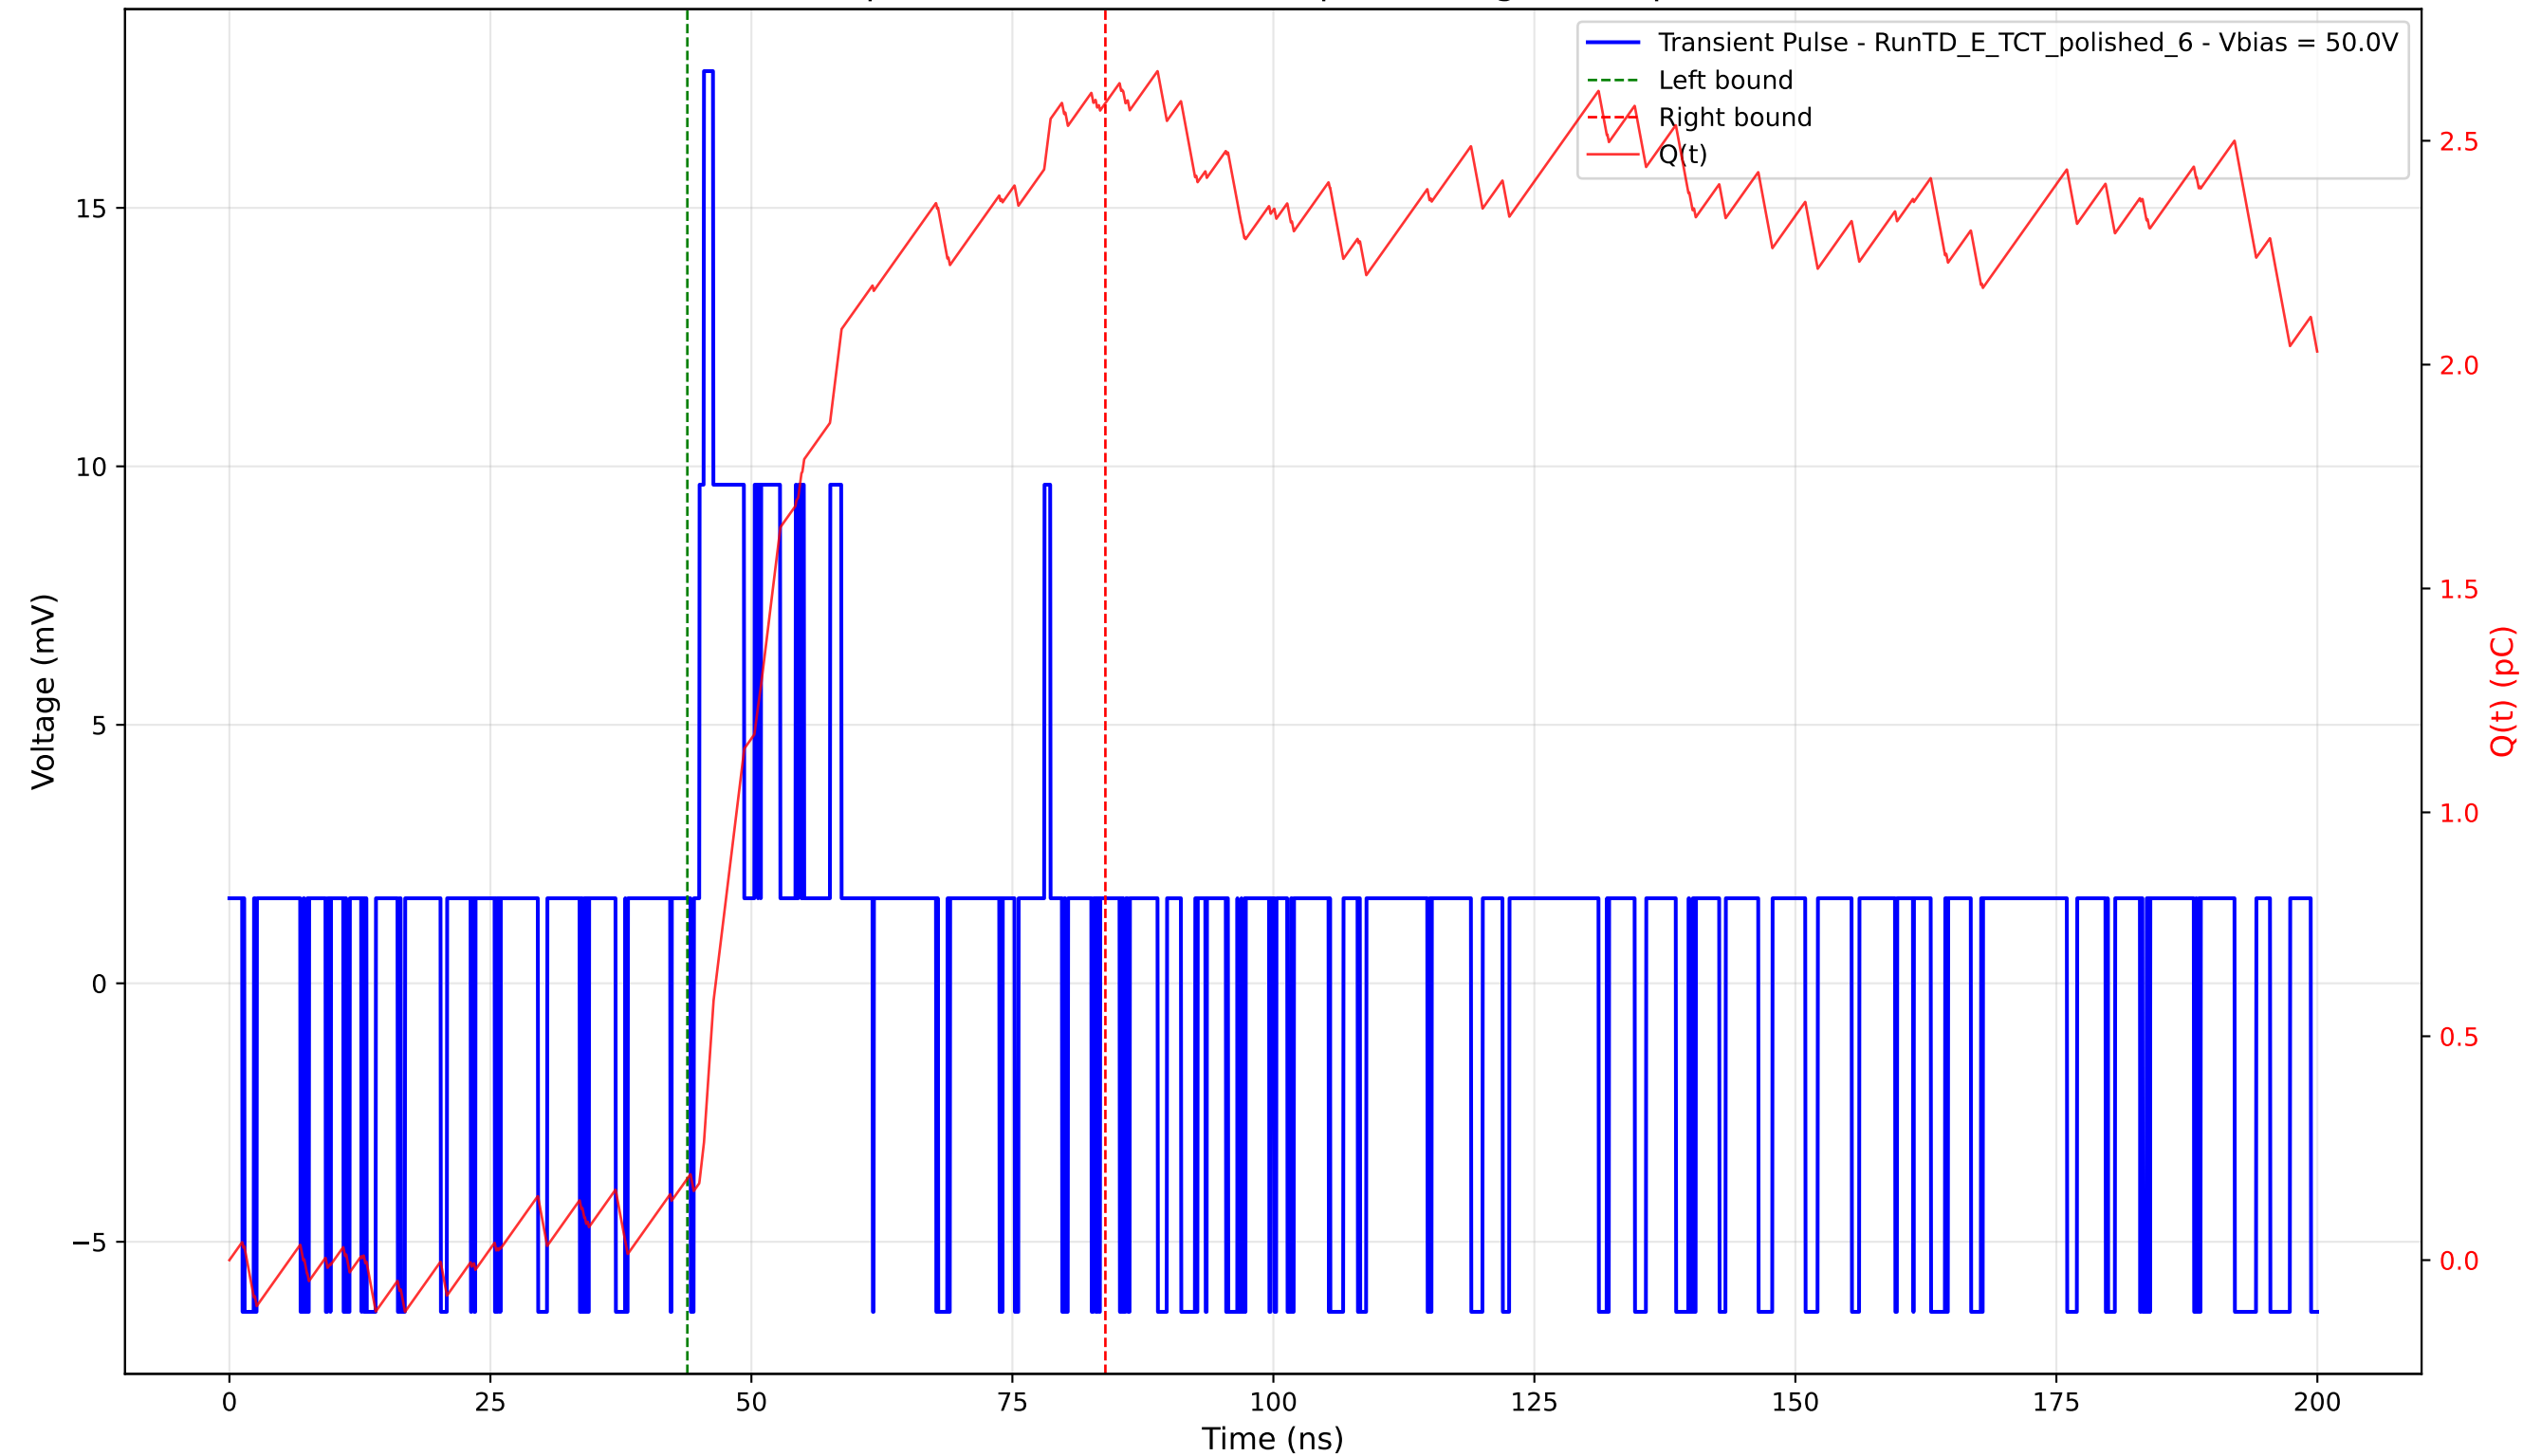


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 1.51 pC - Rise Time: 1.34 ns

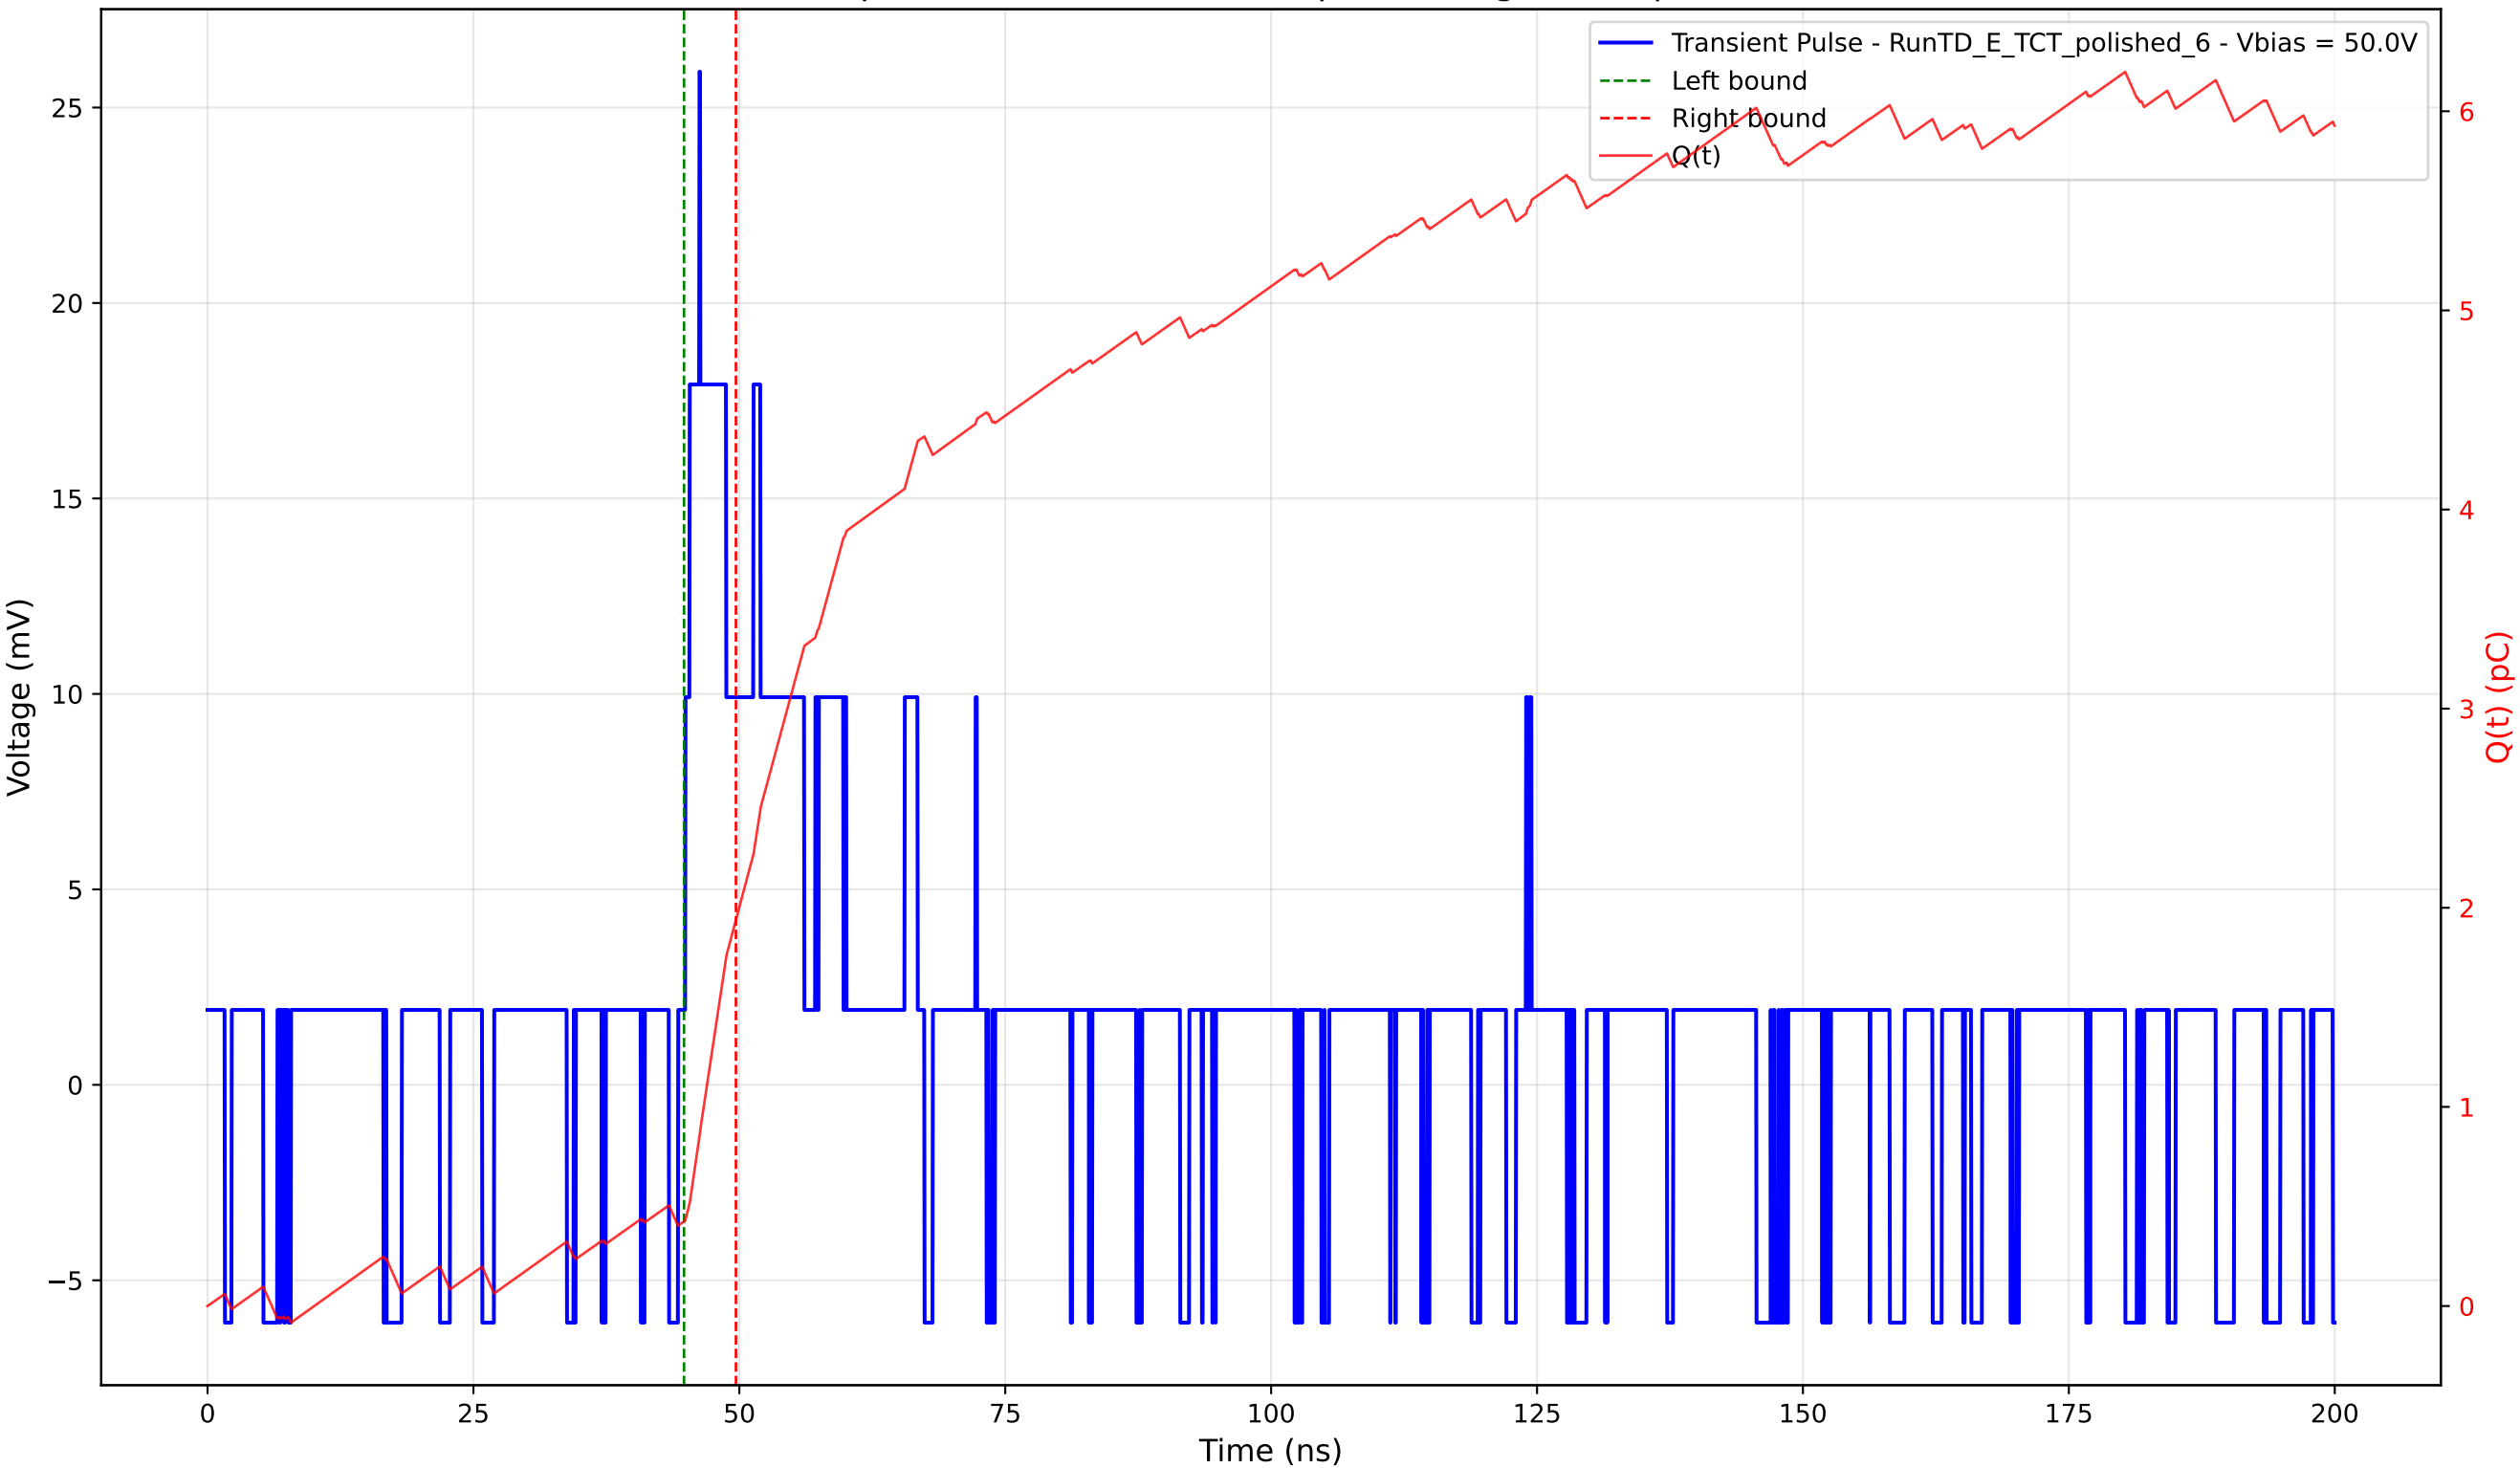


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.51 pC - Rise Time: 1.02 ns

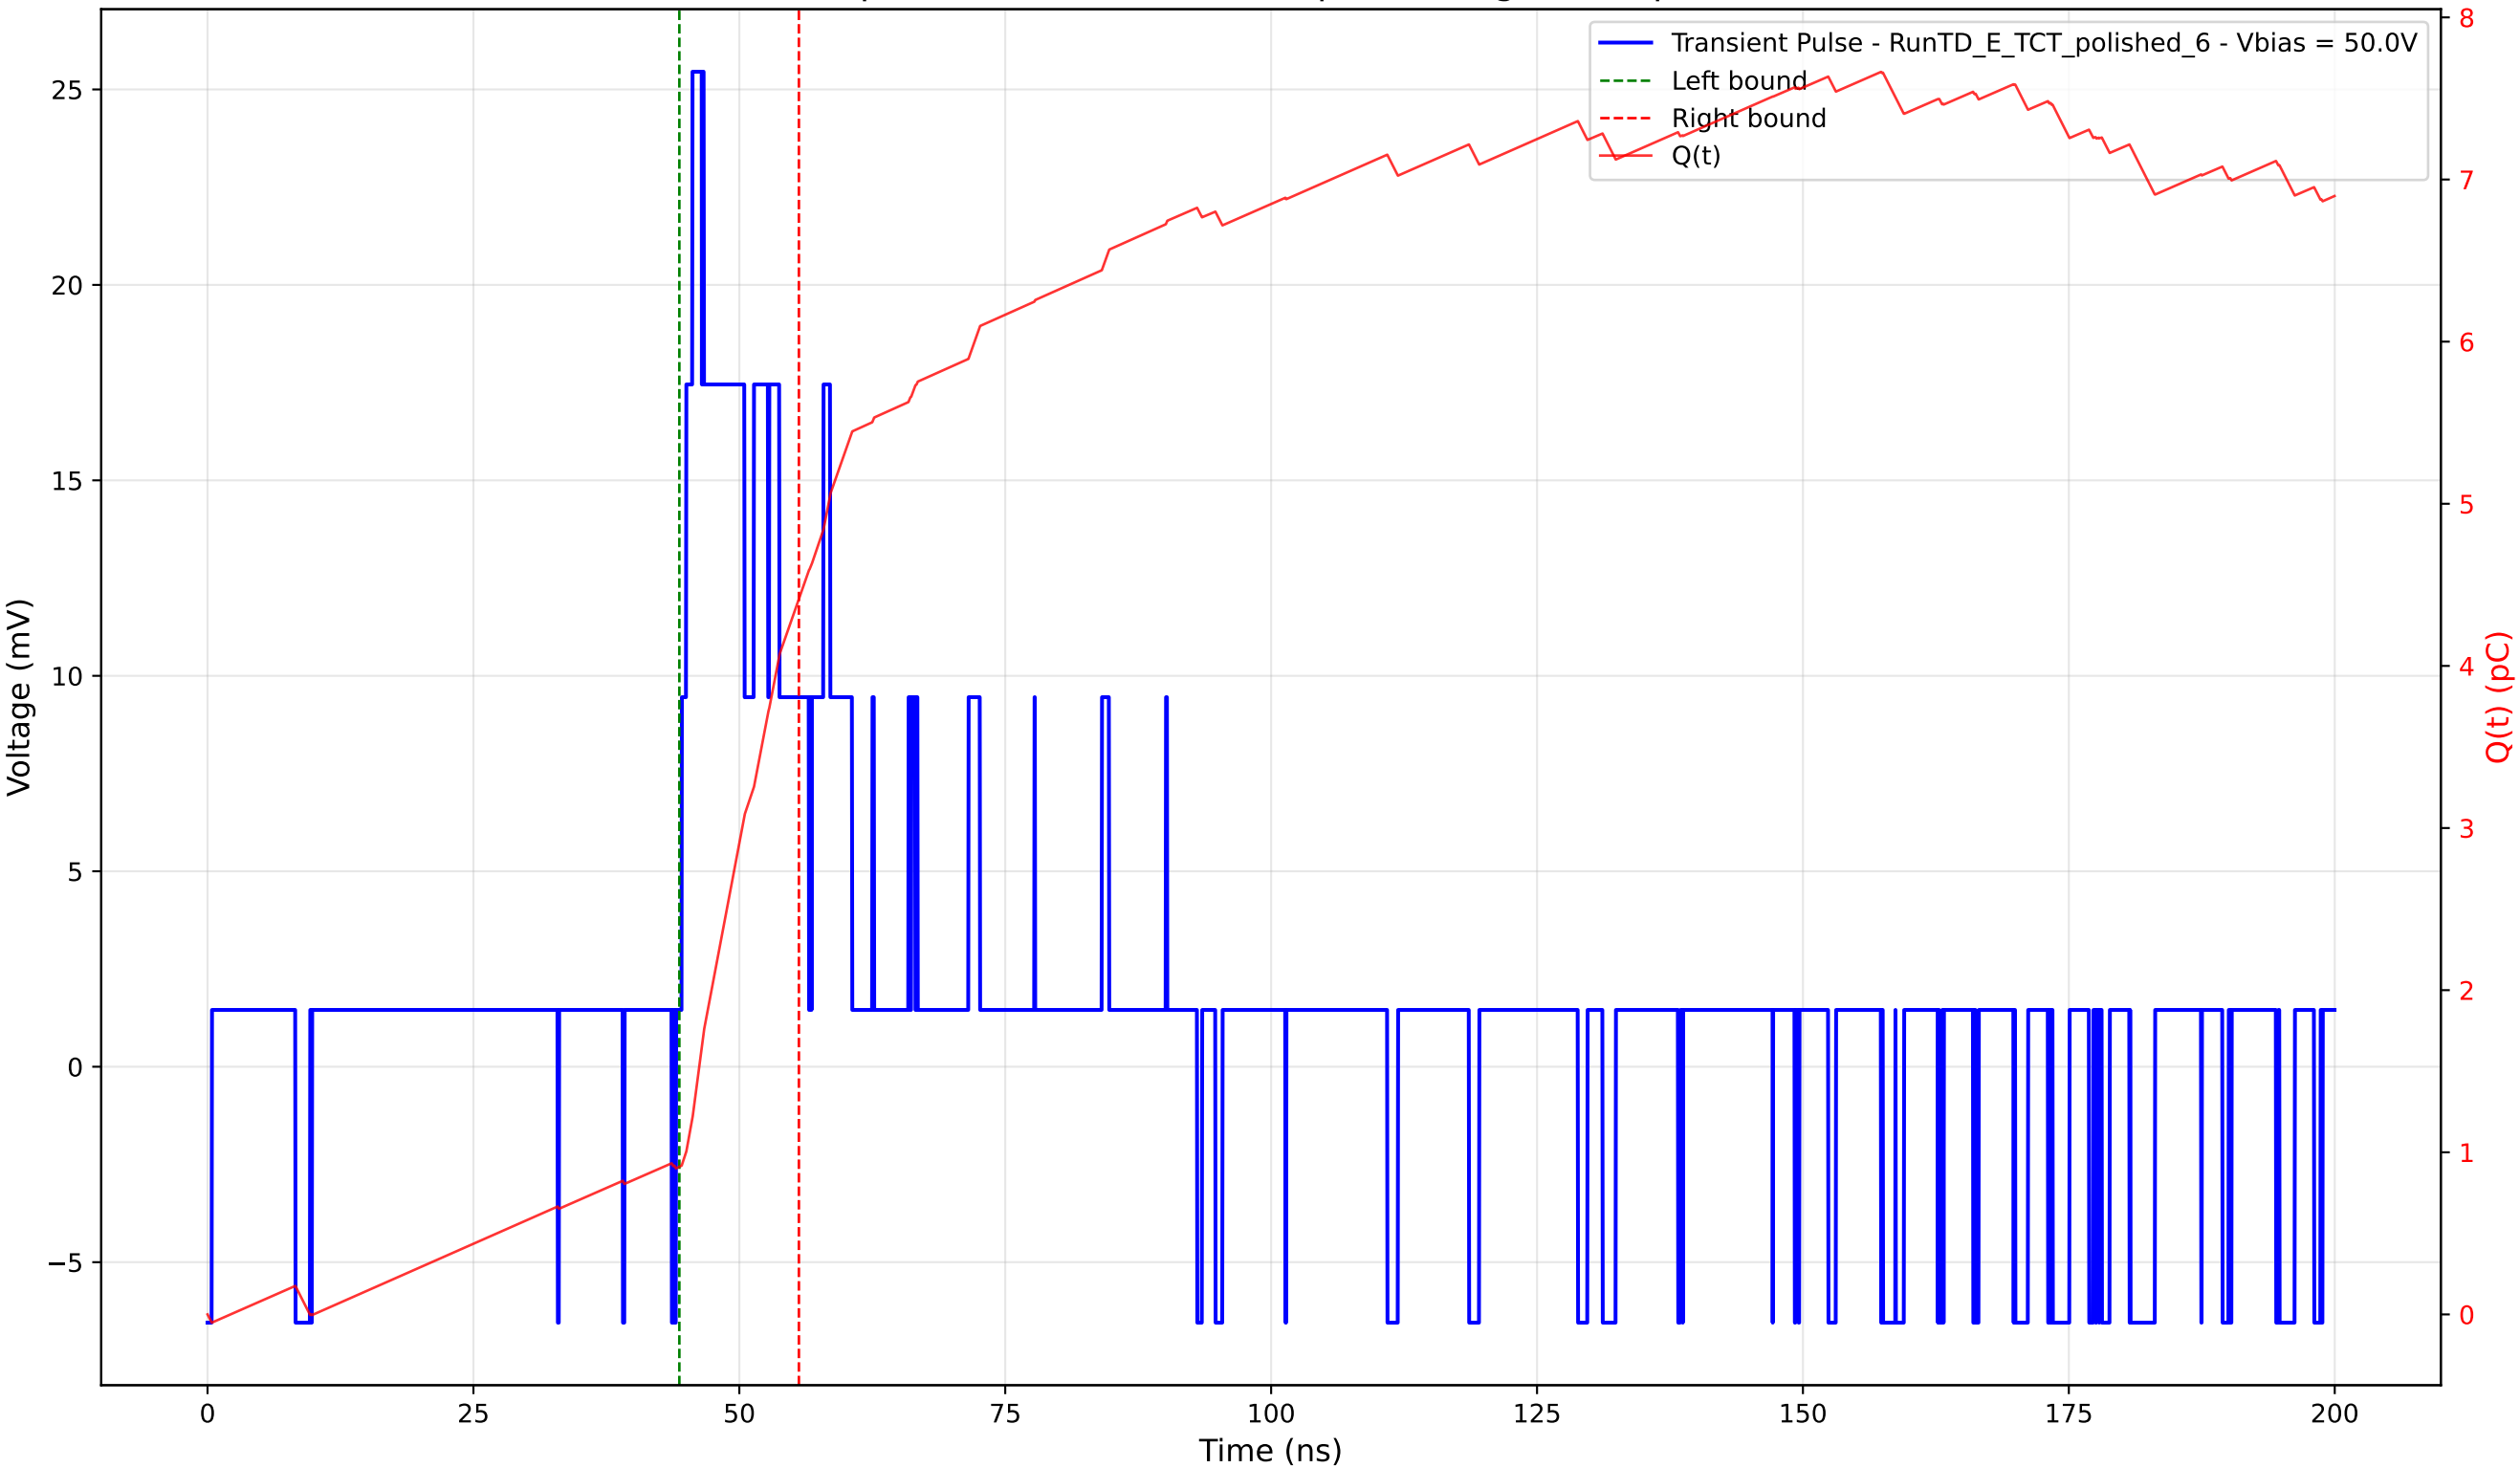


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 5.45 pC - Rise Time: 0.88 ns

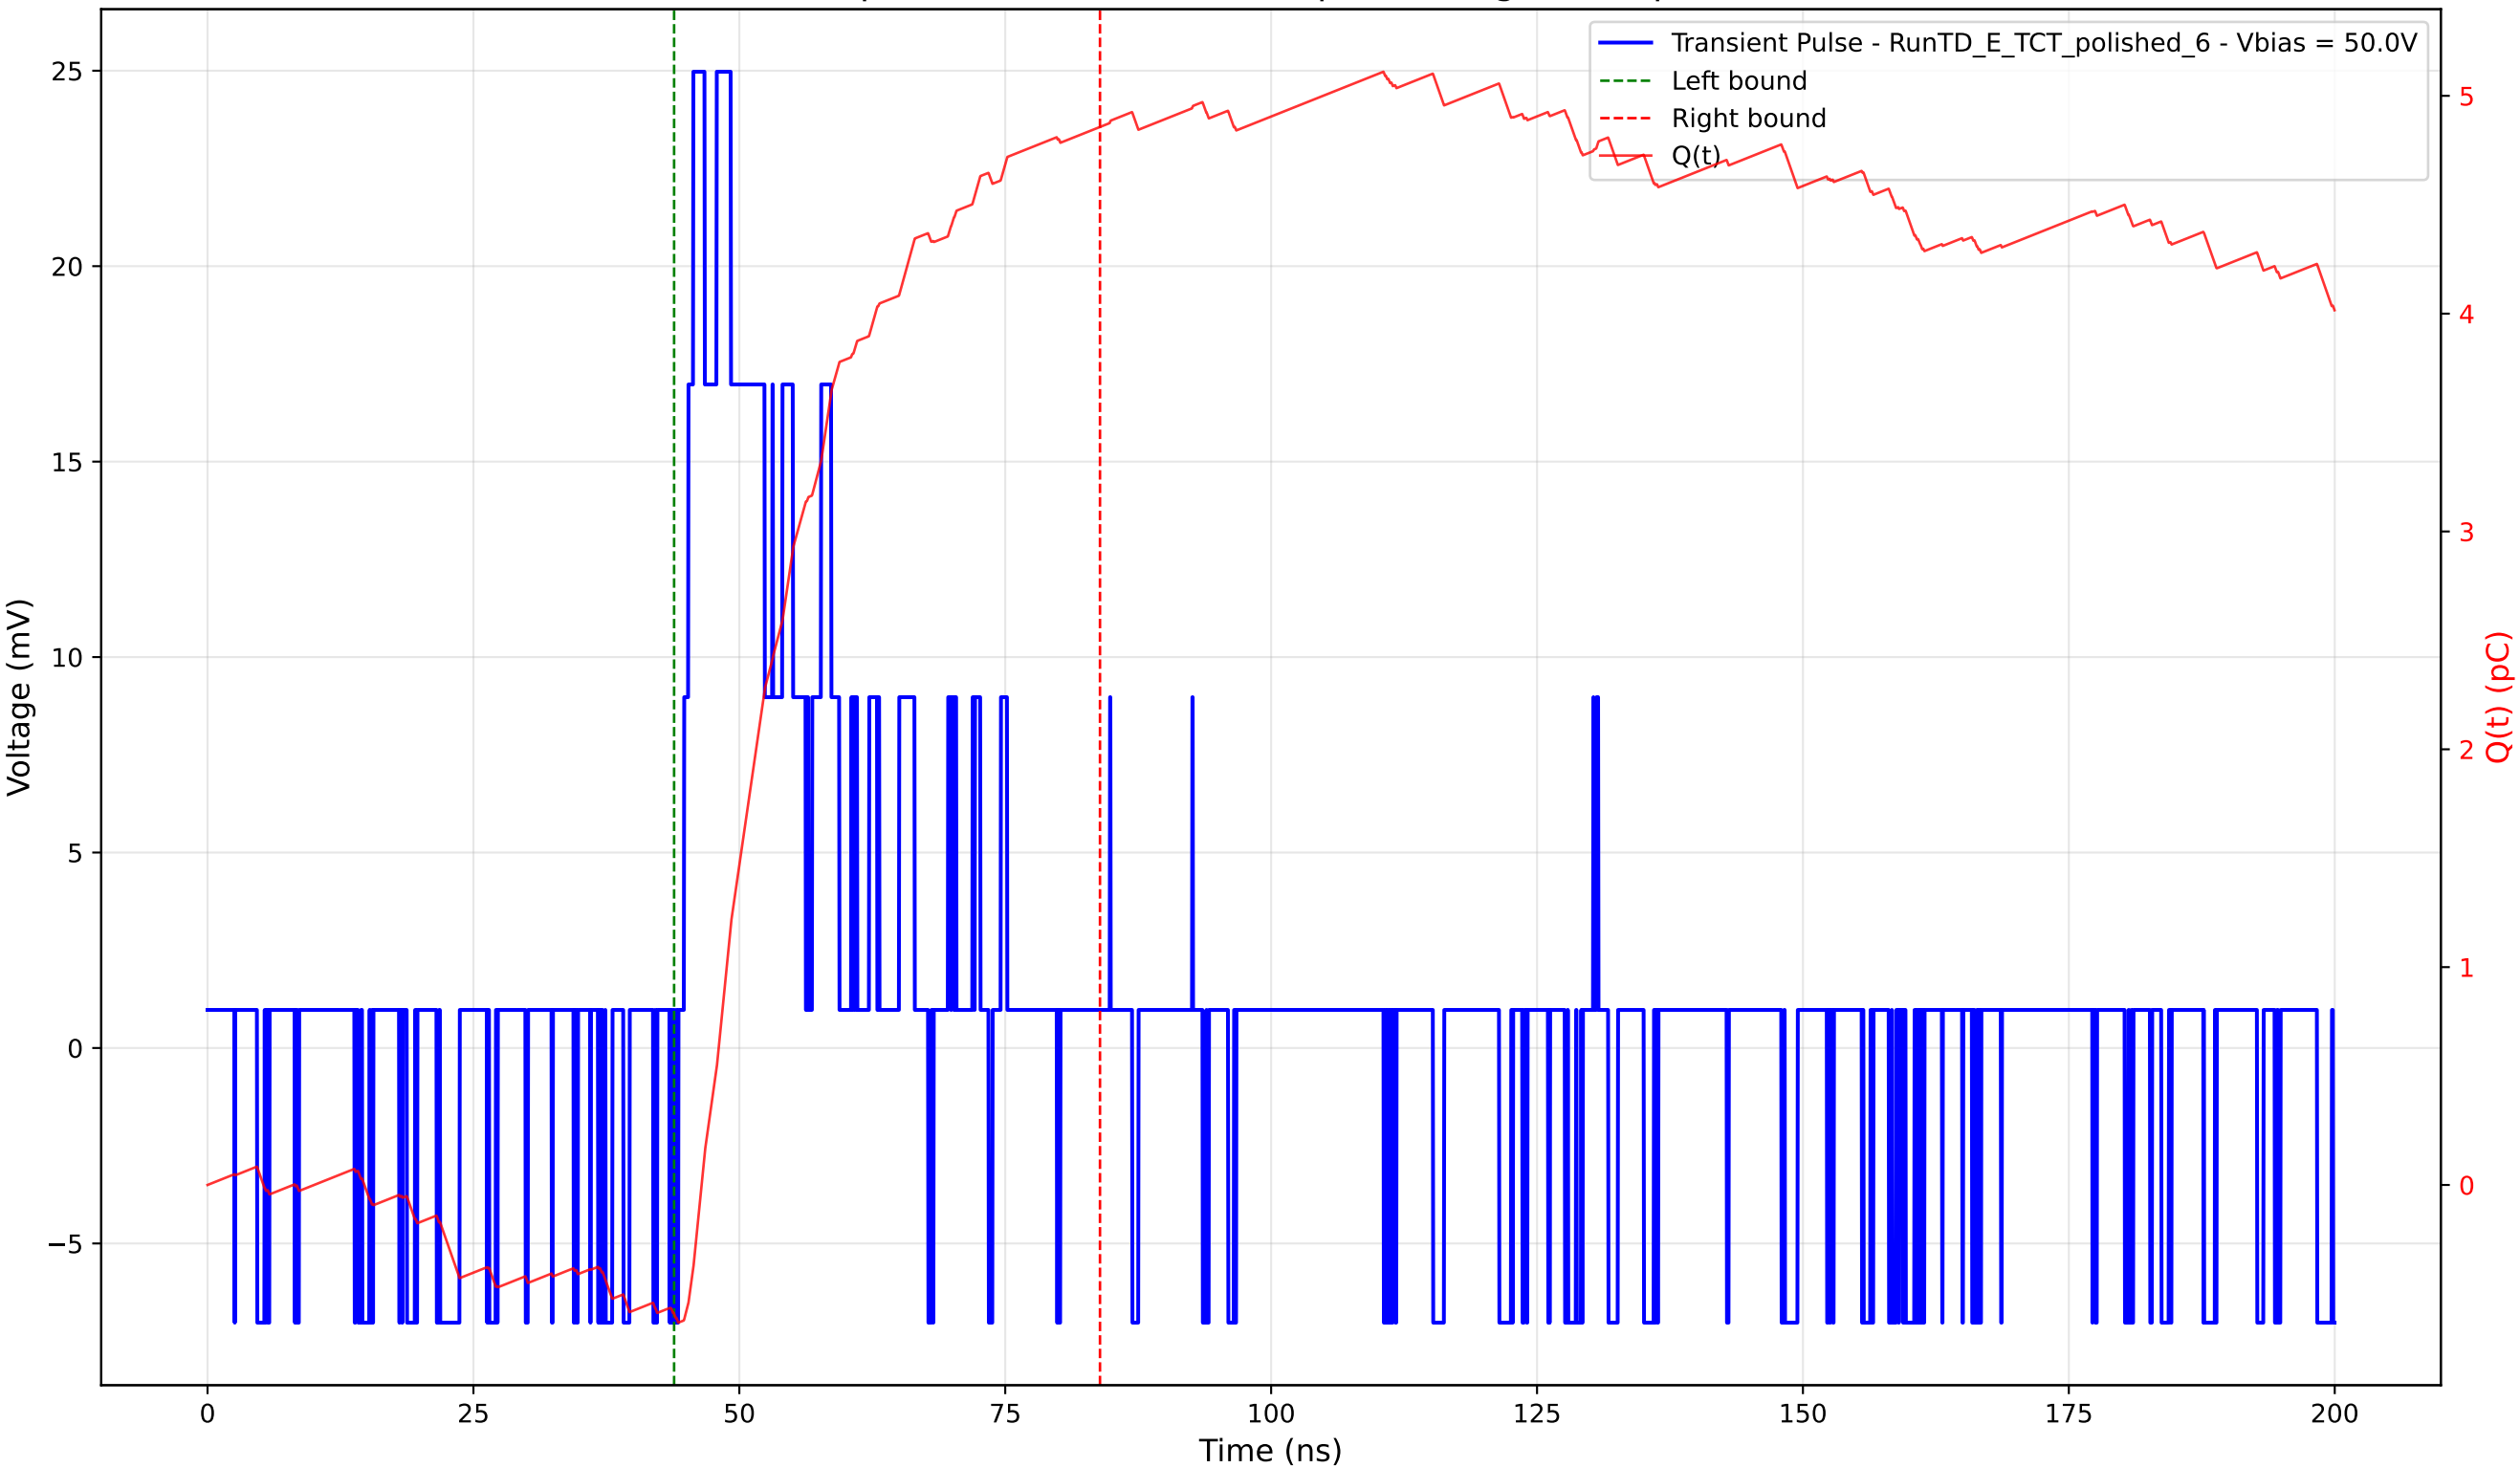


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 4.61 pC - Rise Time: 0.00 ns (N/A)

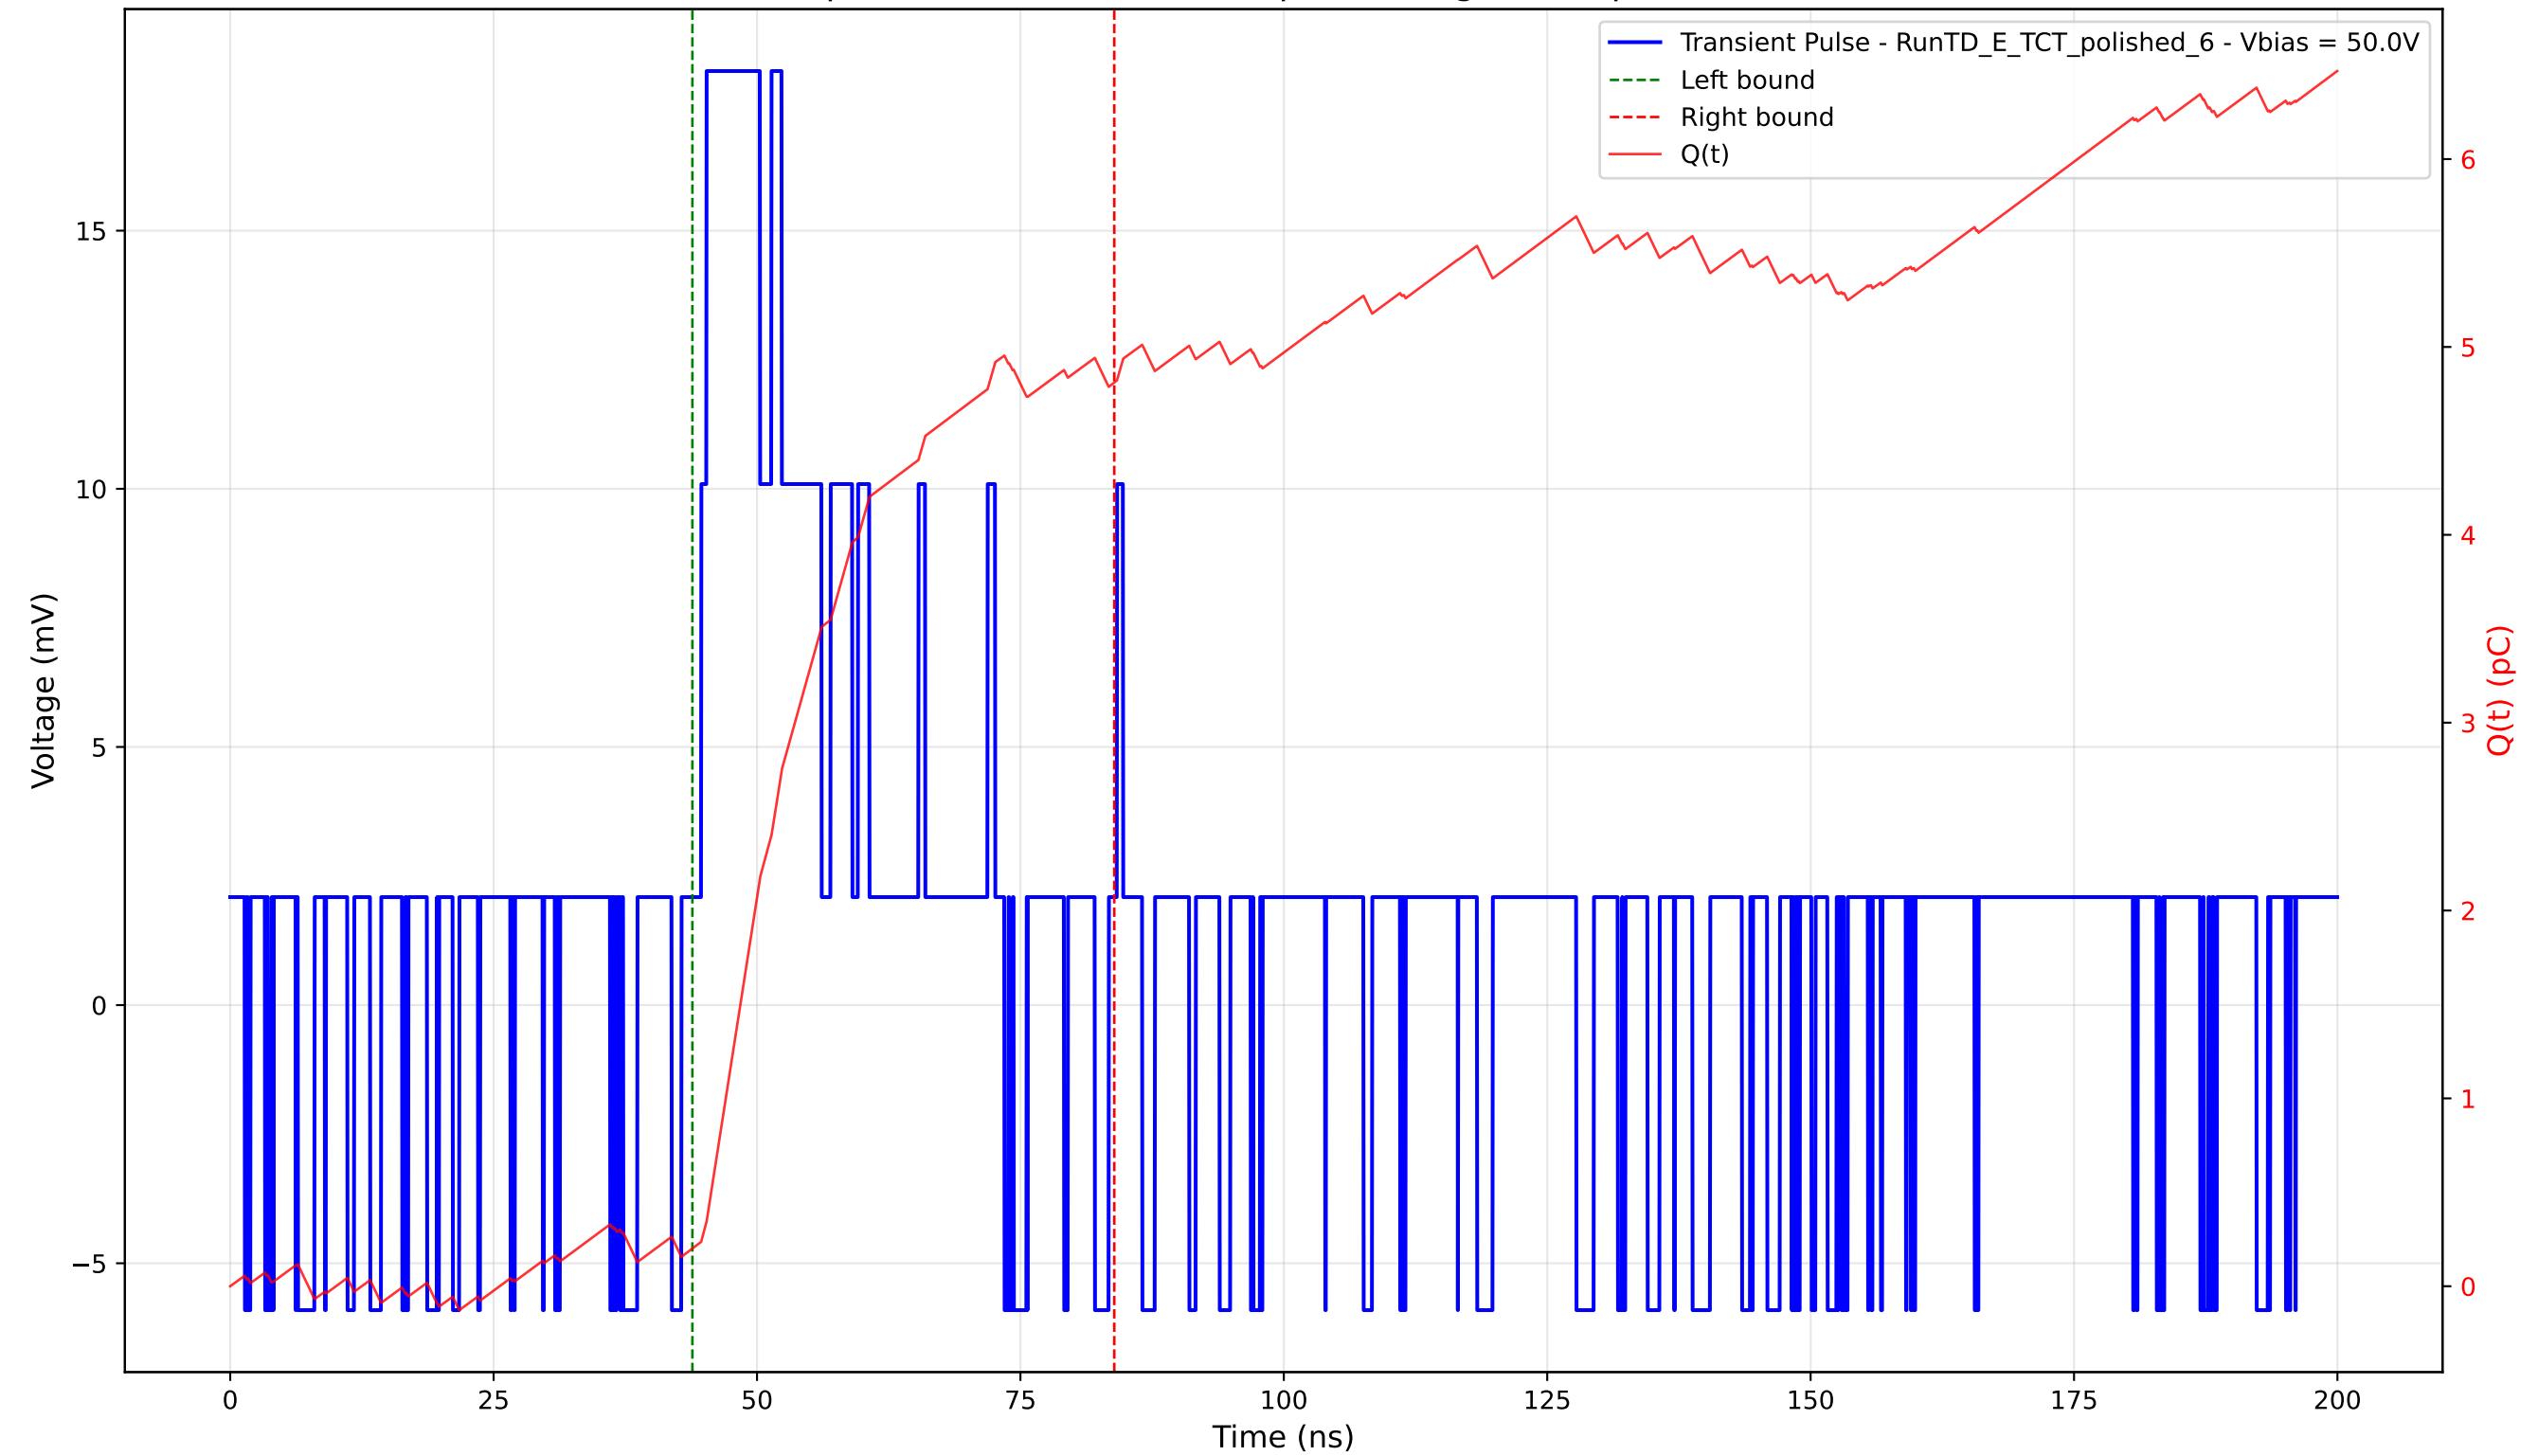


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 2.52 pC - Rise Time: 0.70 ns

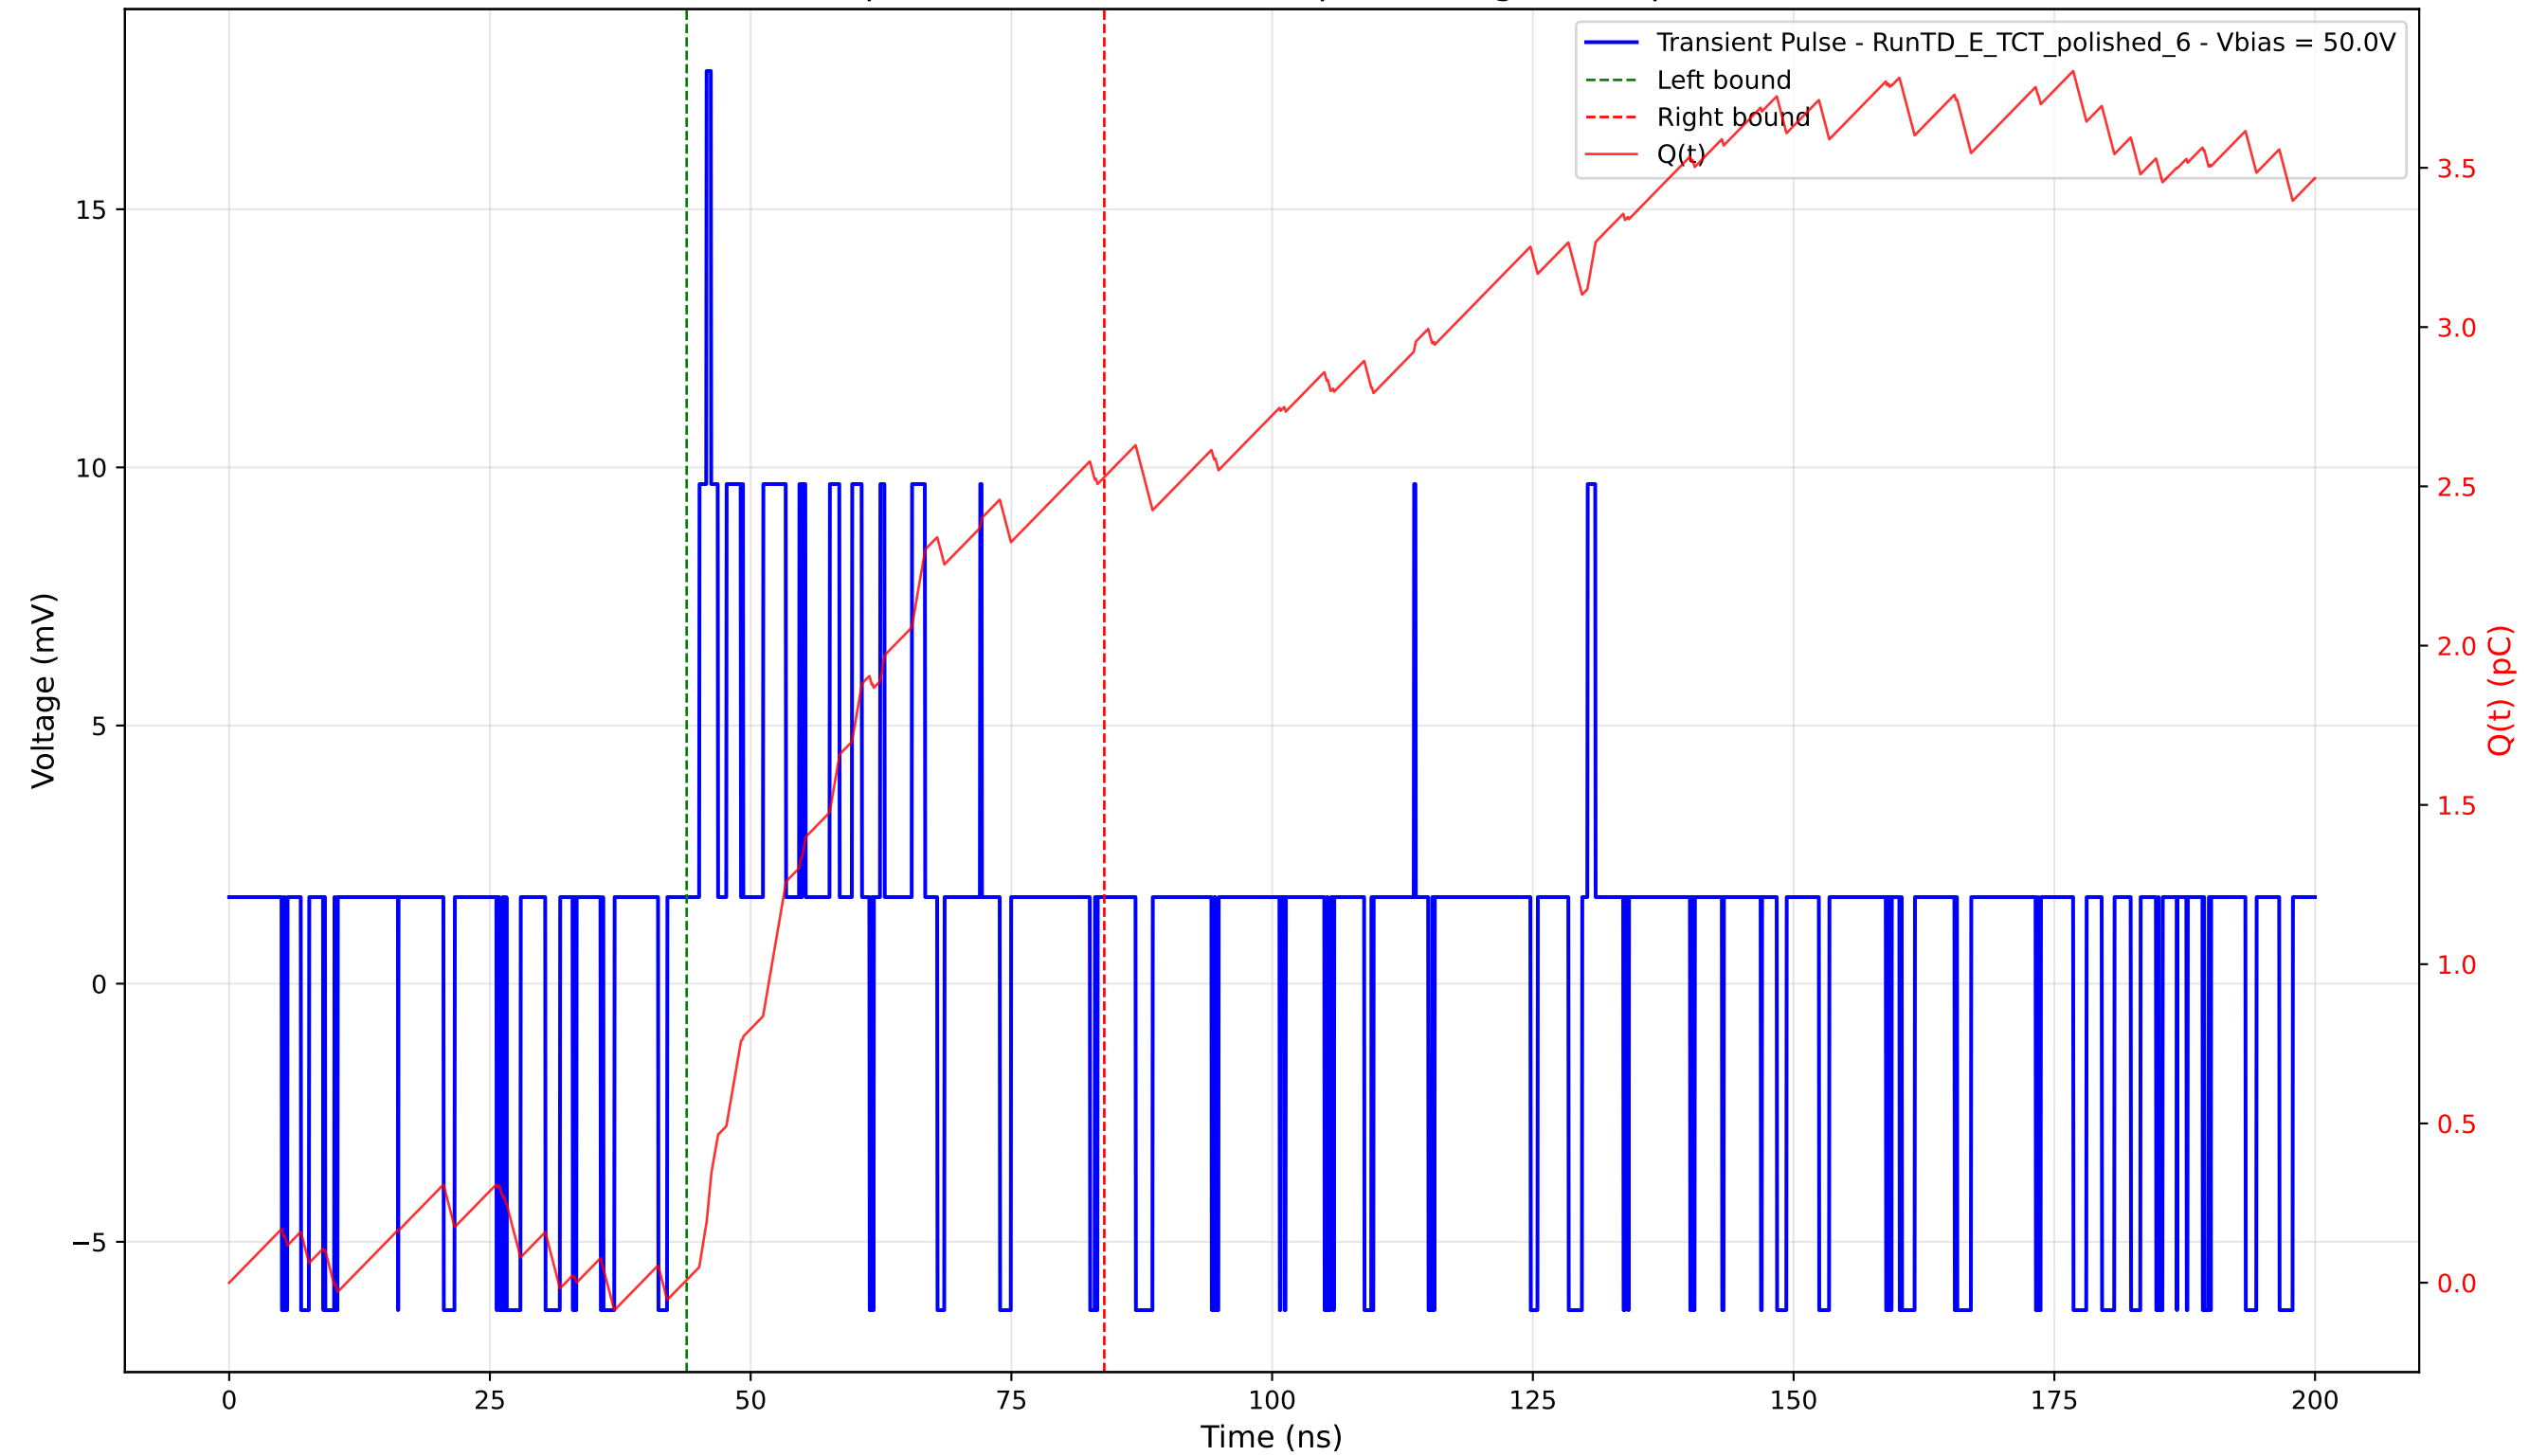


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 1.12 pC - Rise Time: 0.00 ns (N/A)

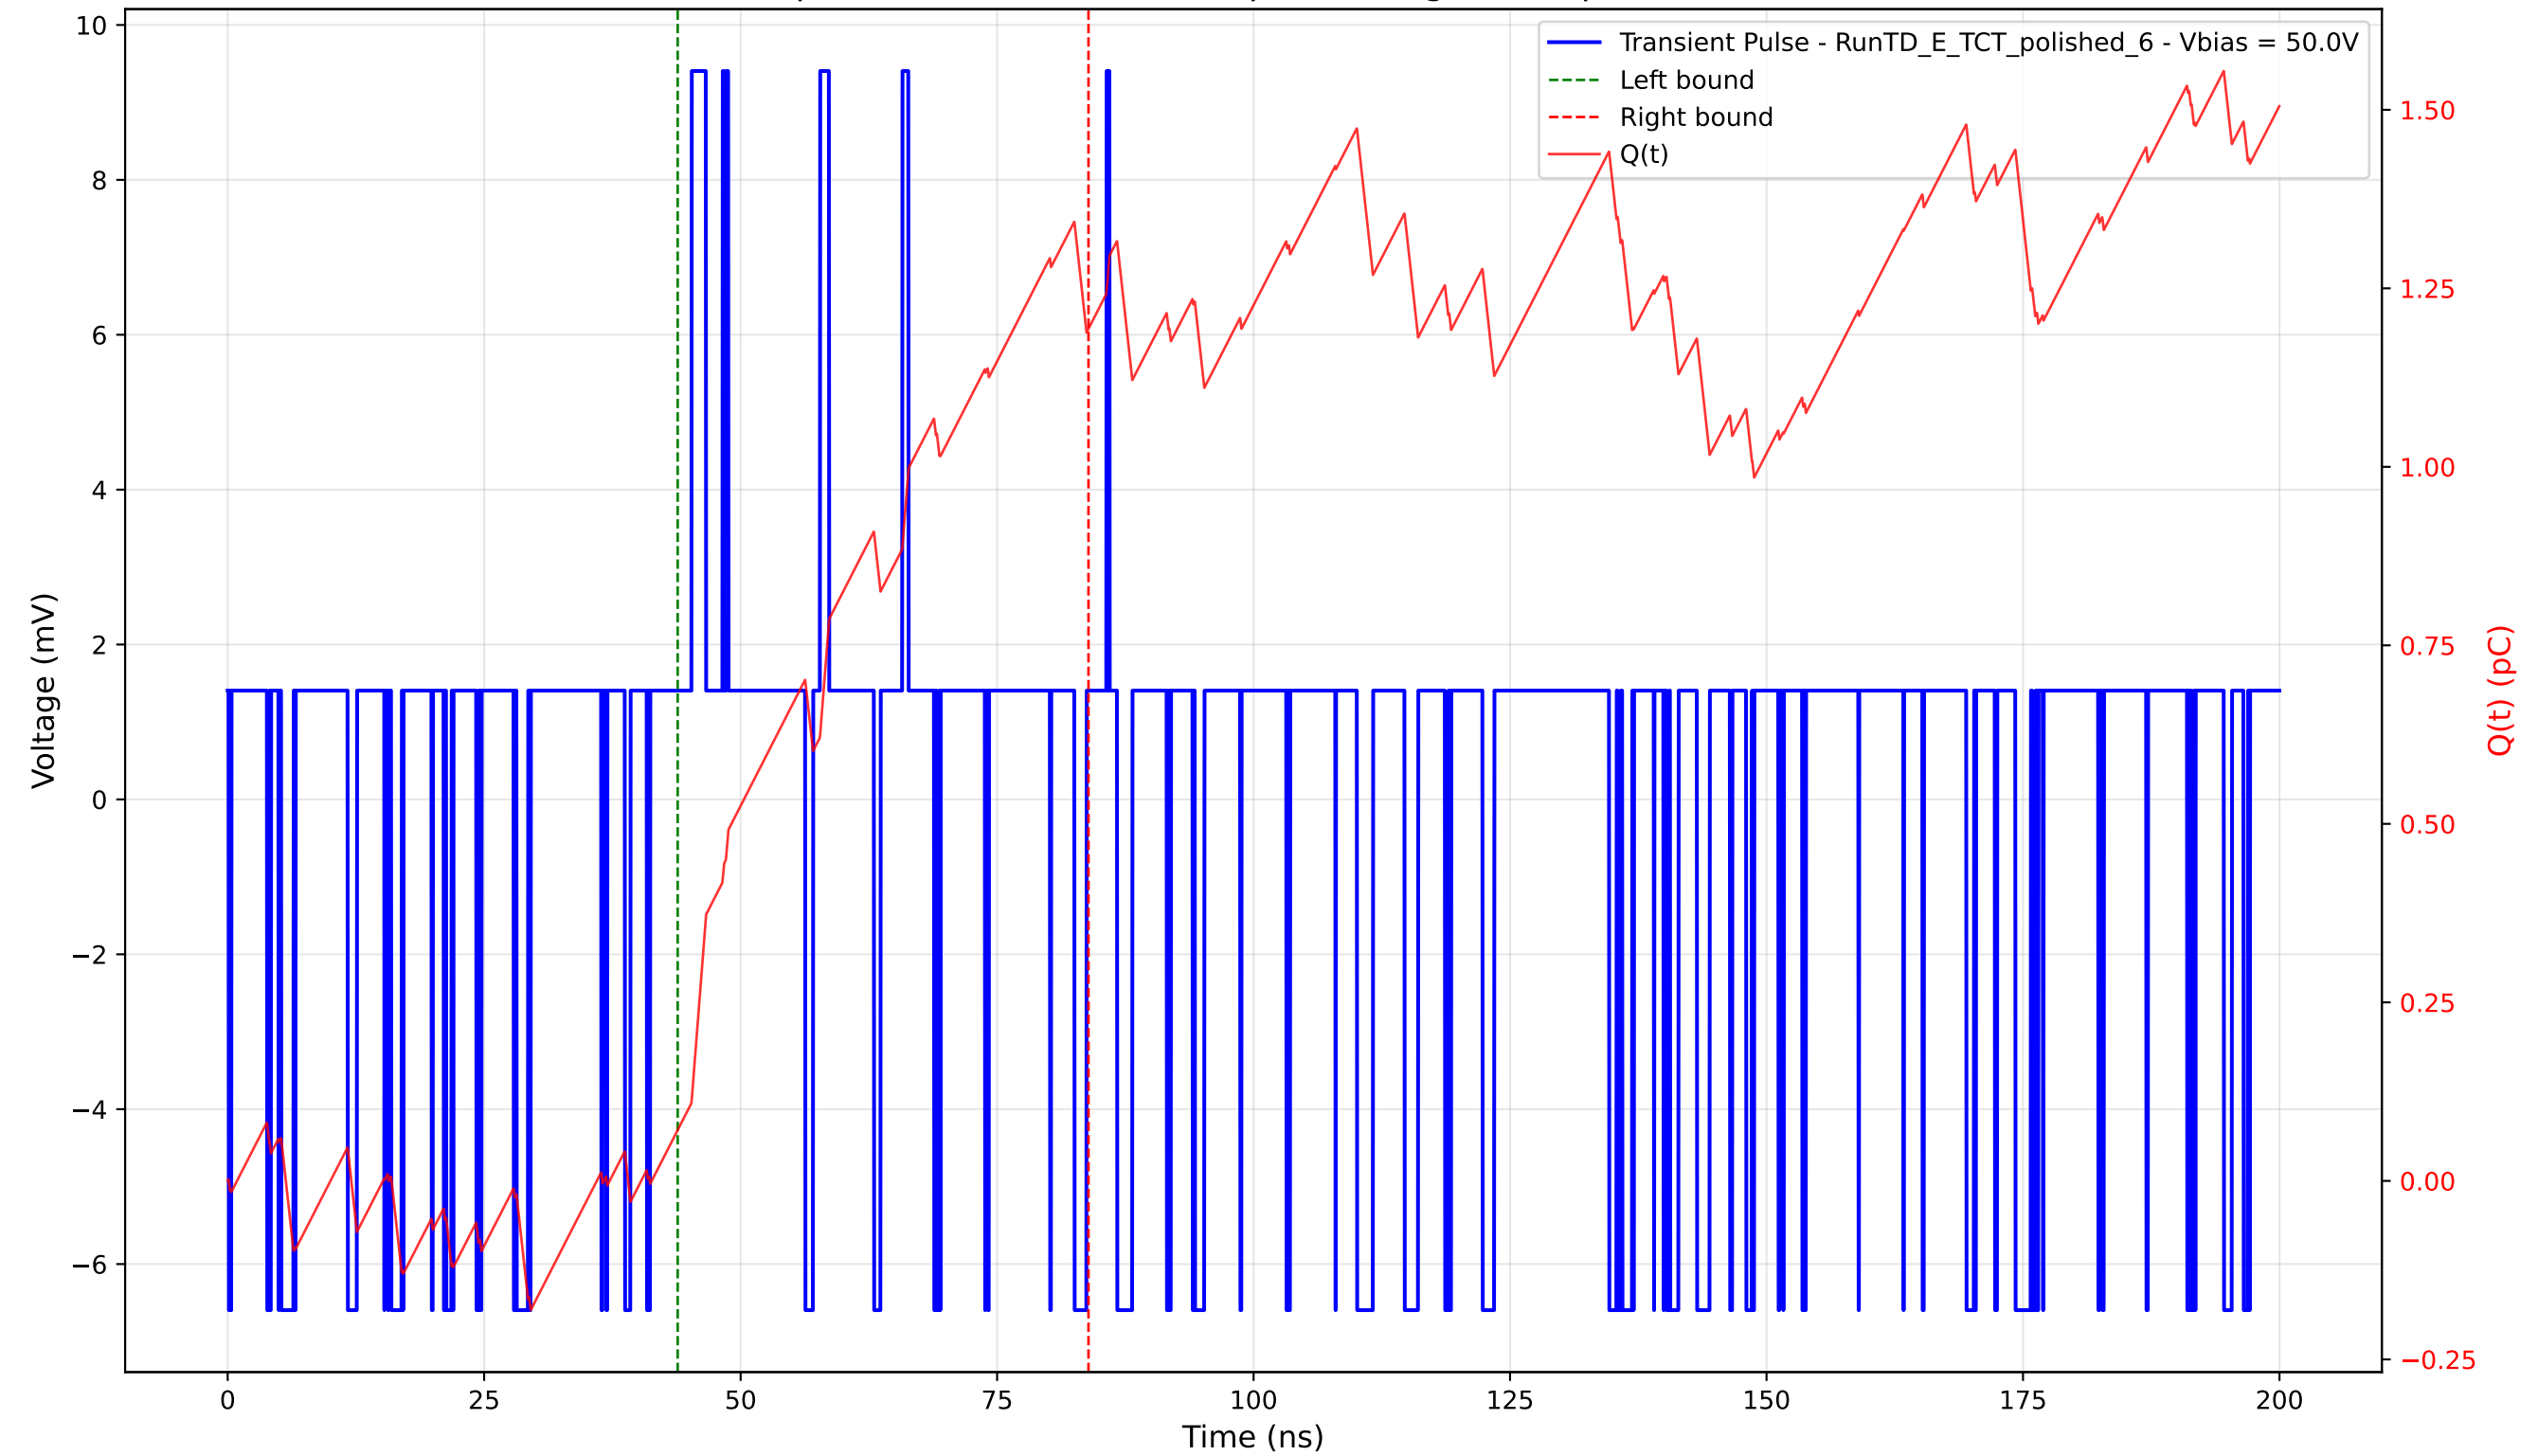


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 0.52 pC - Rise Time: 0.62 ns

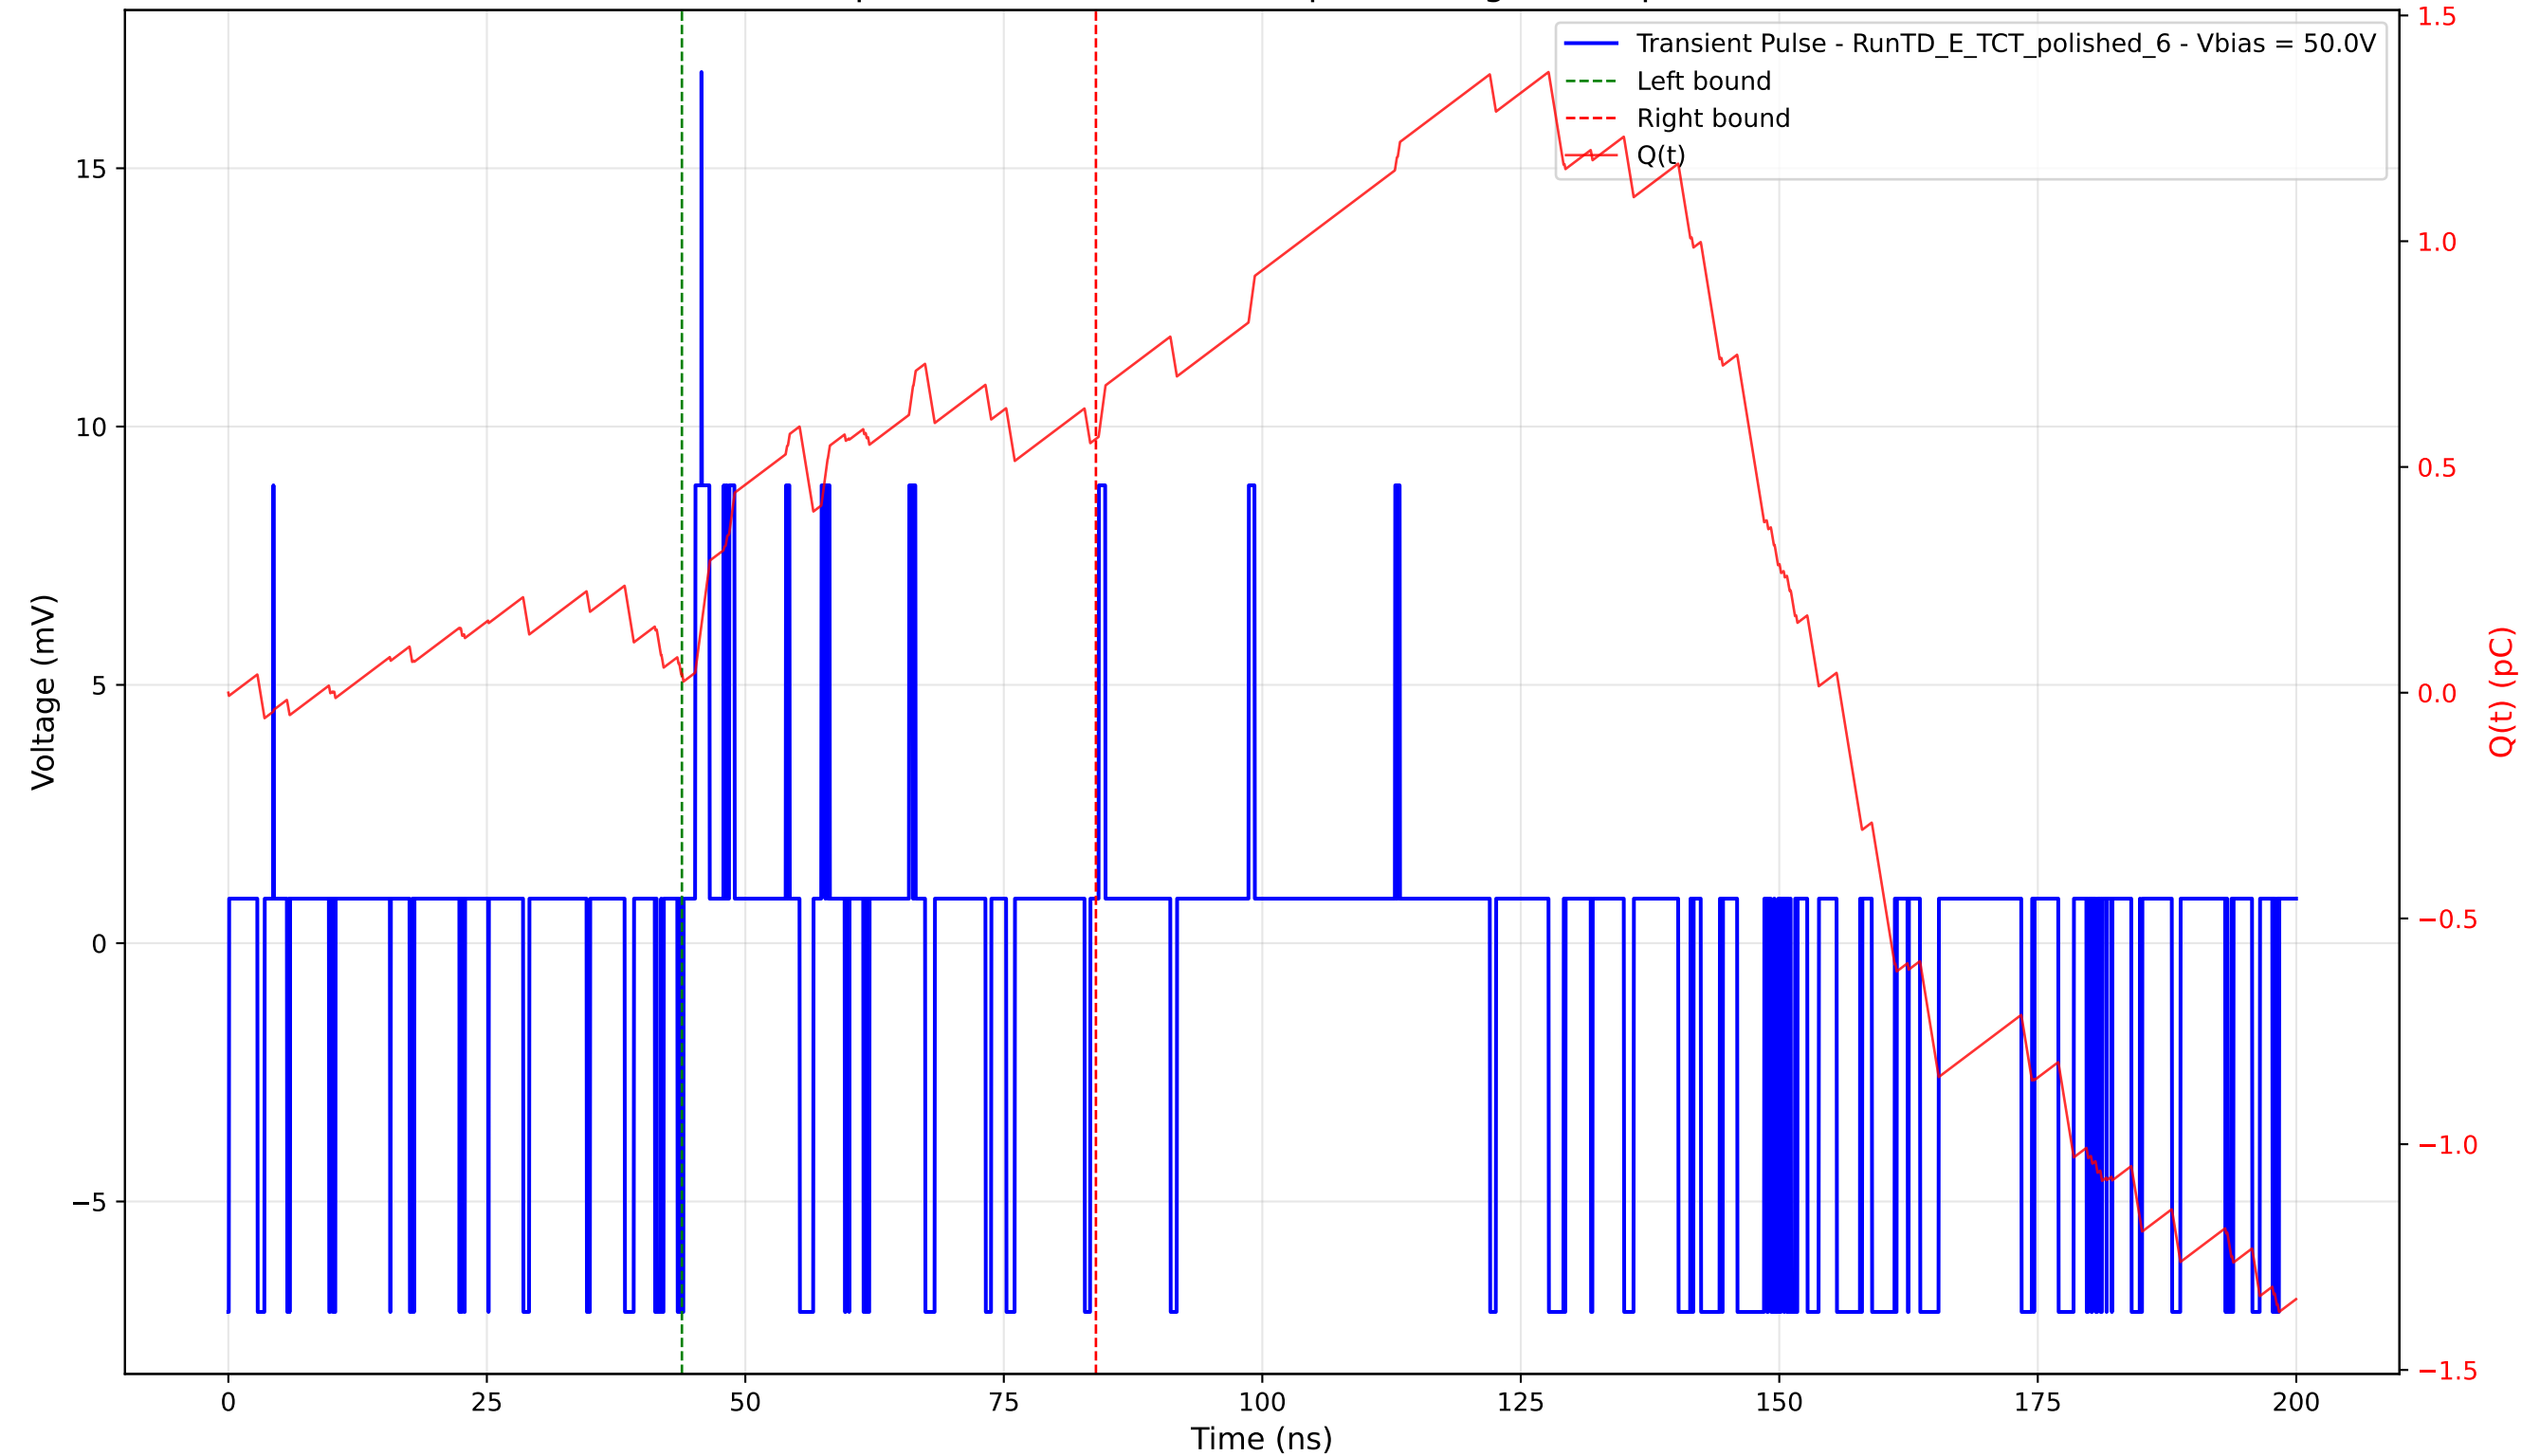


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 0.99 pC - Rise Time: 0.00 ns (N/A)

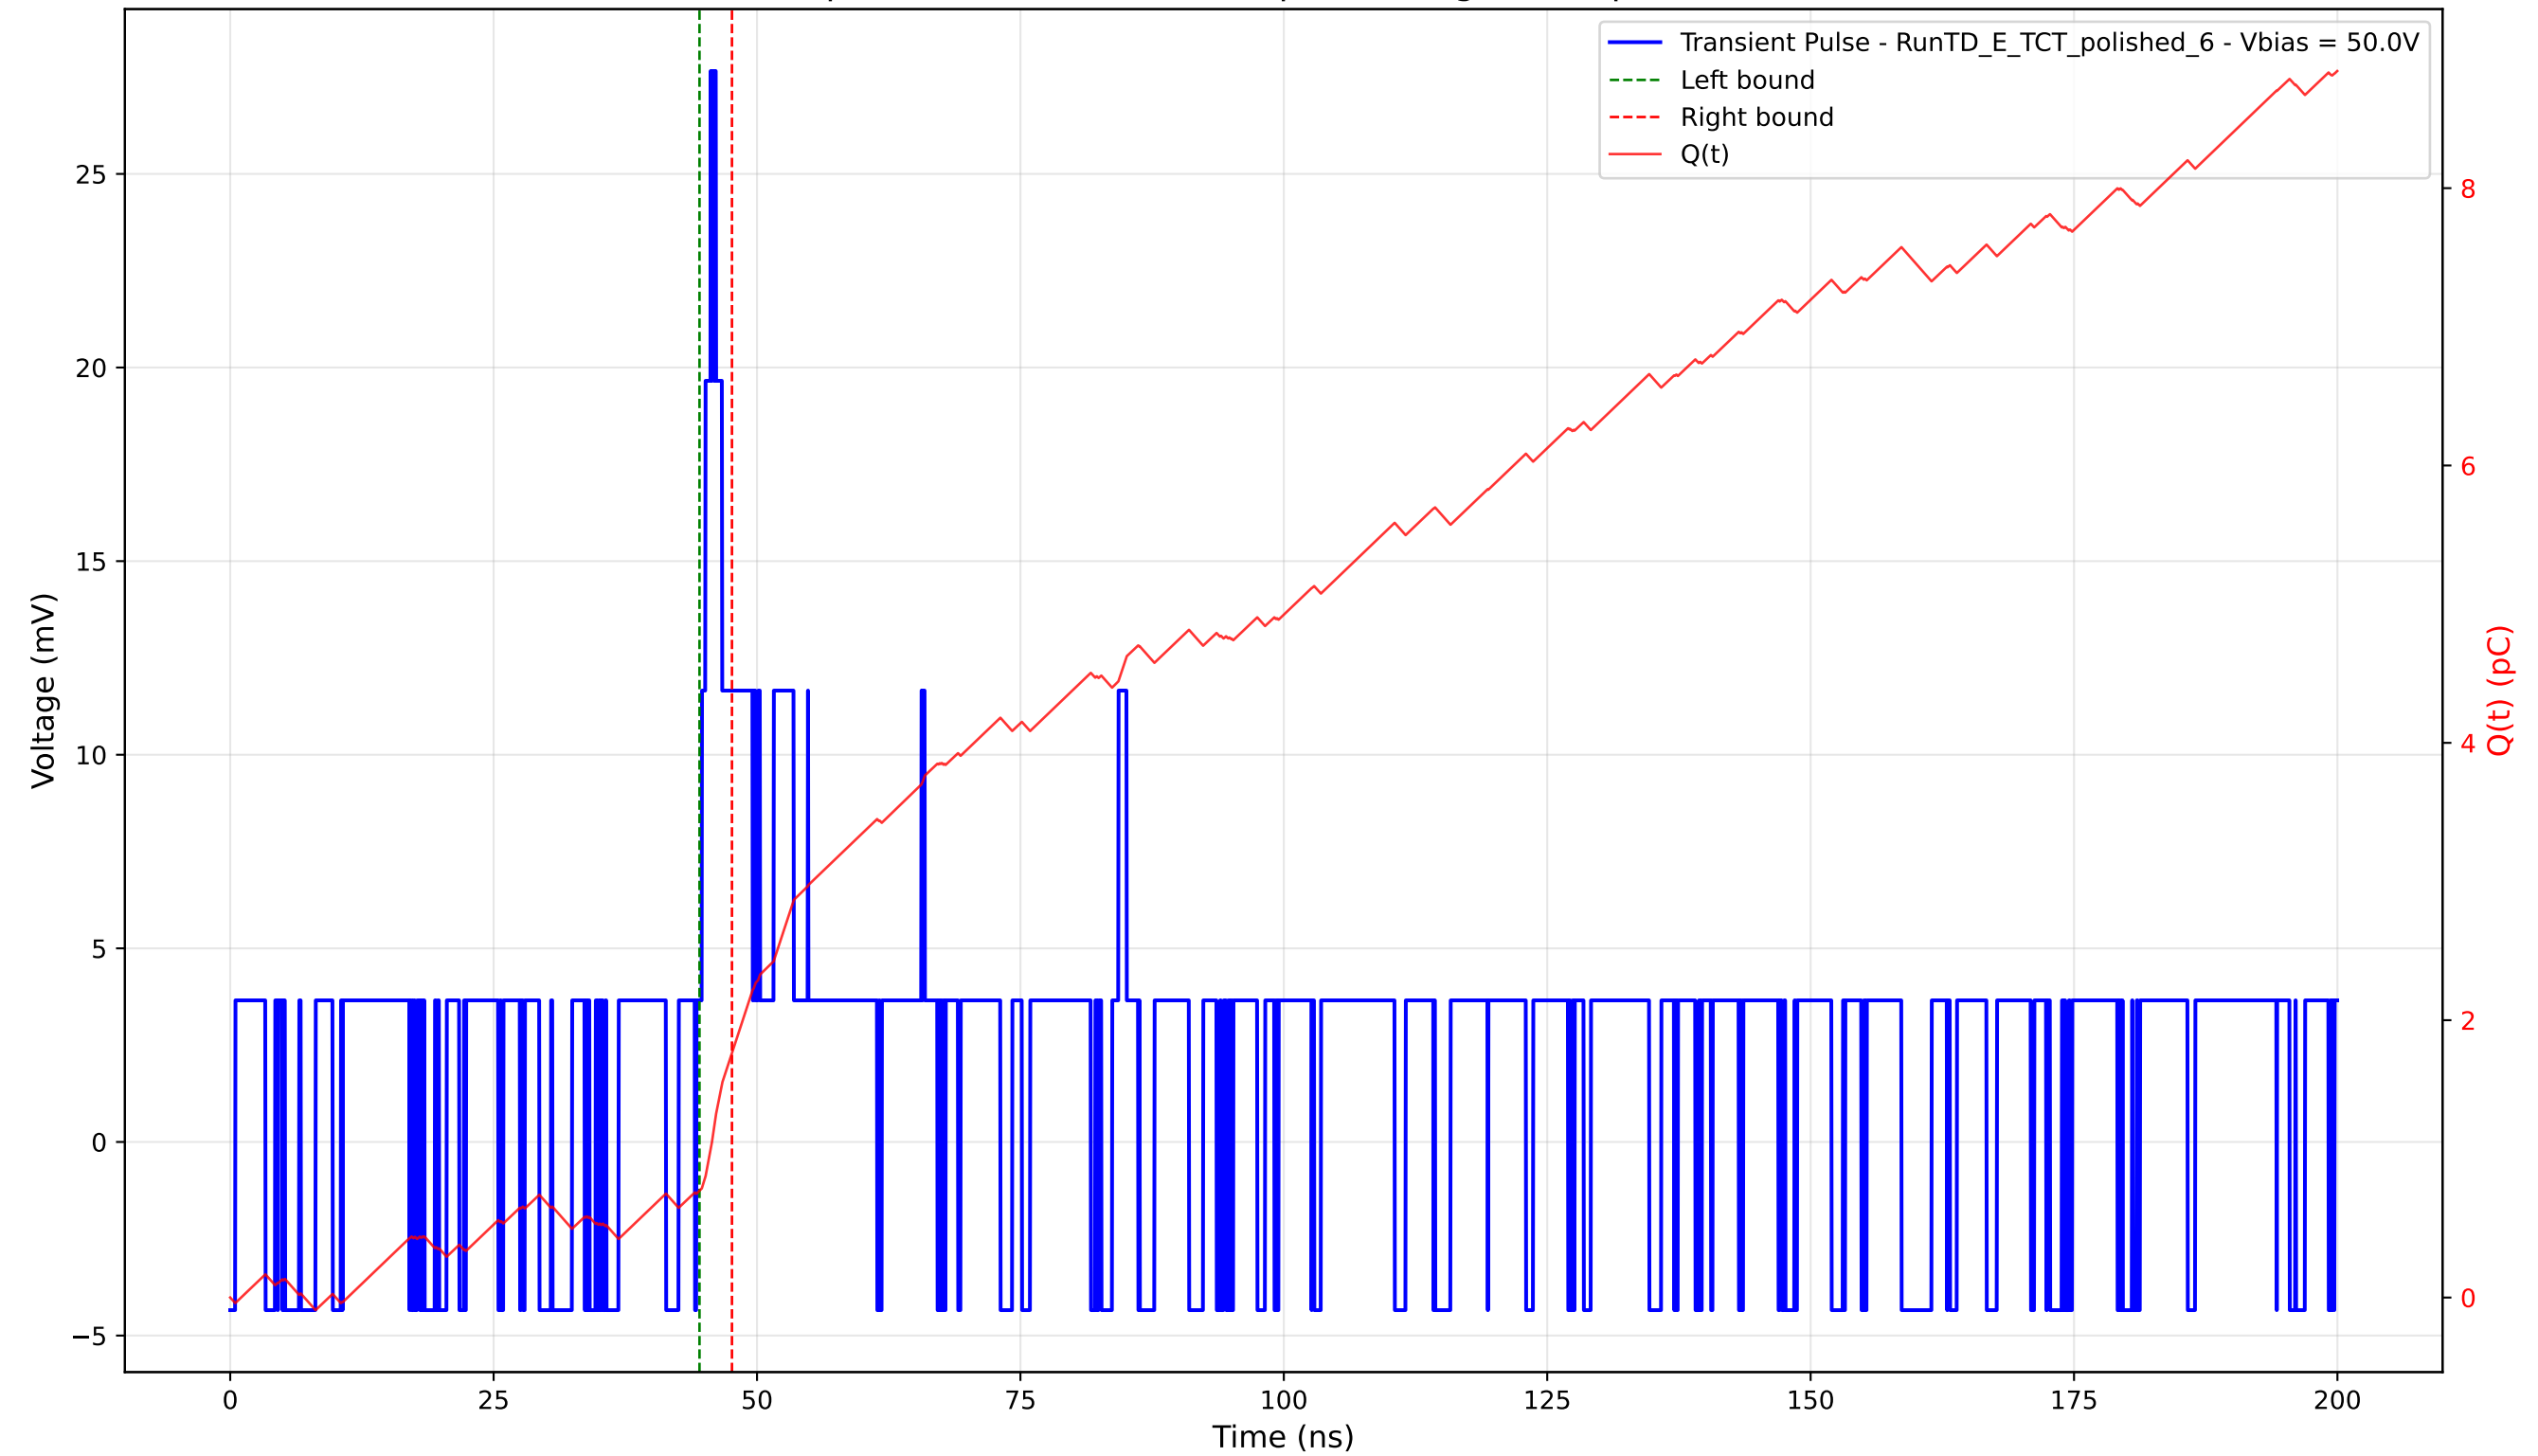


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 3.80 pC - Rise Time: 0.86 ns

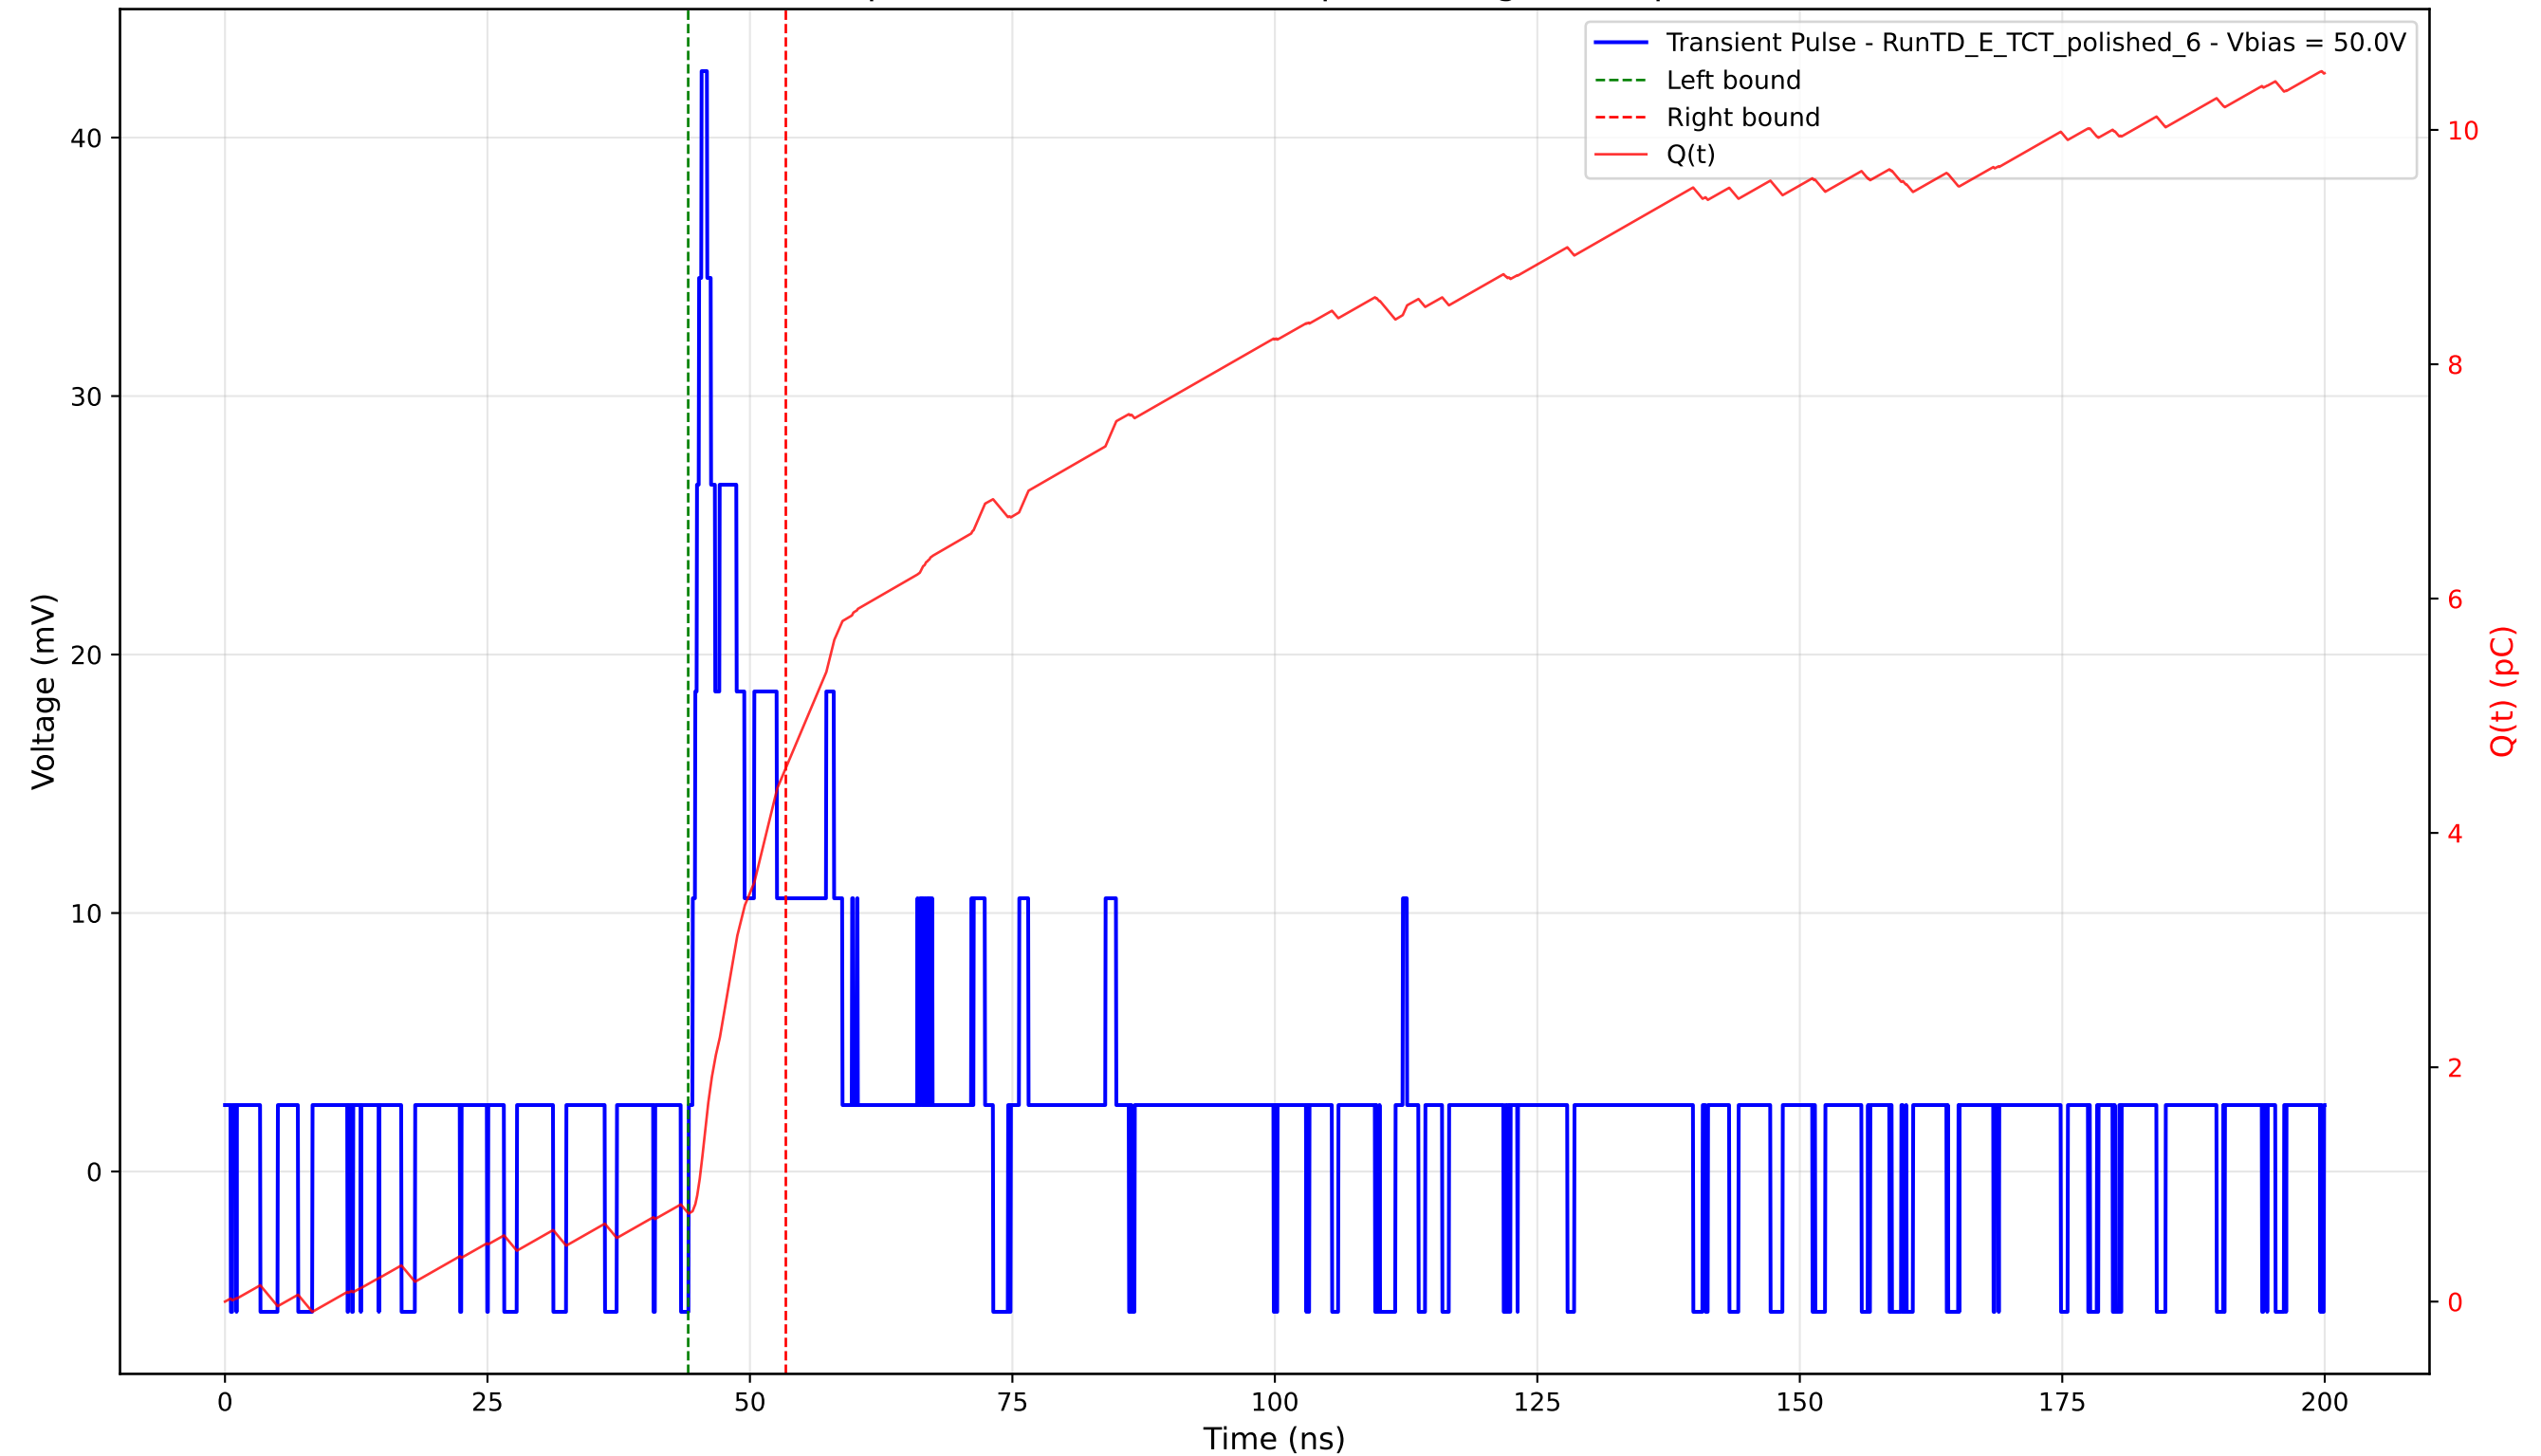


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 9.79 pC - Rise Time: 0.98 ns

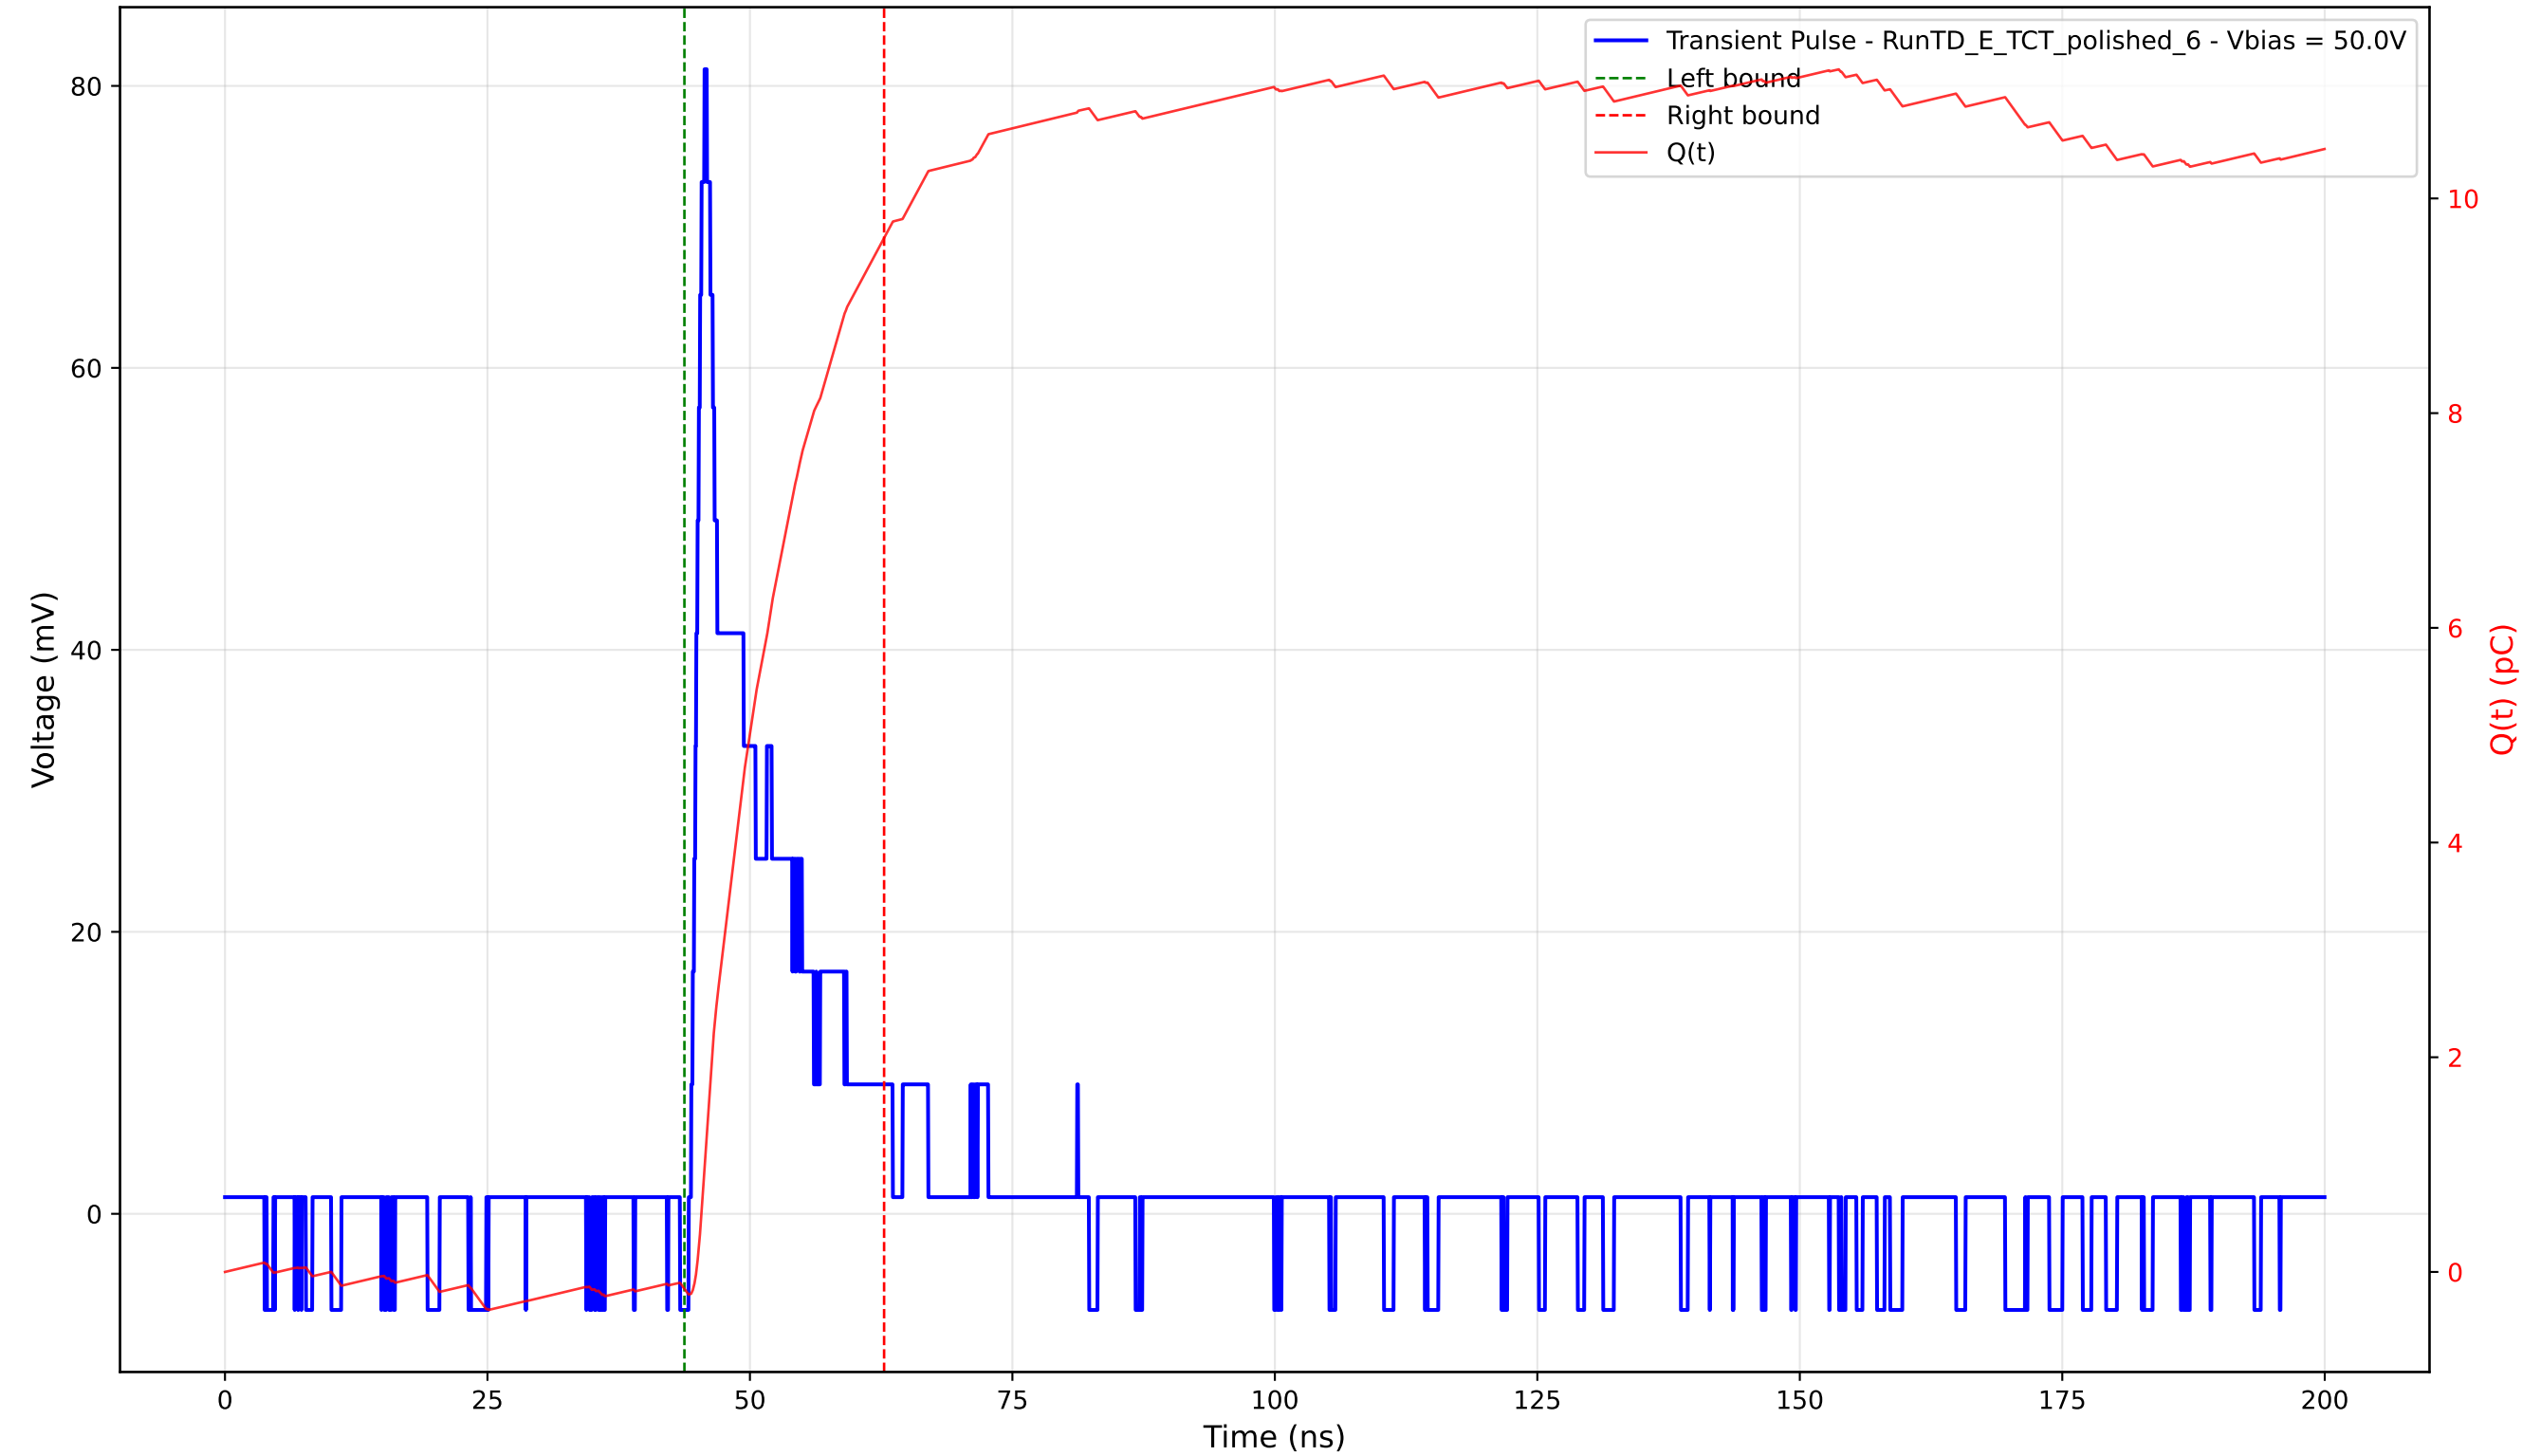


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 17.21 pC - Rise Time: 0.95 ns

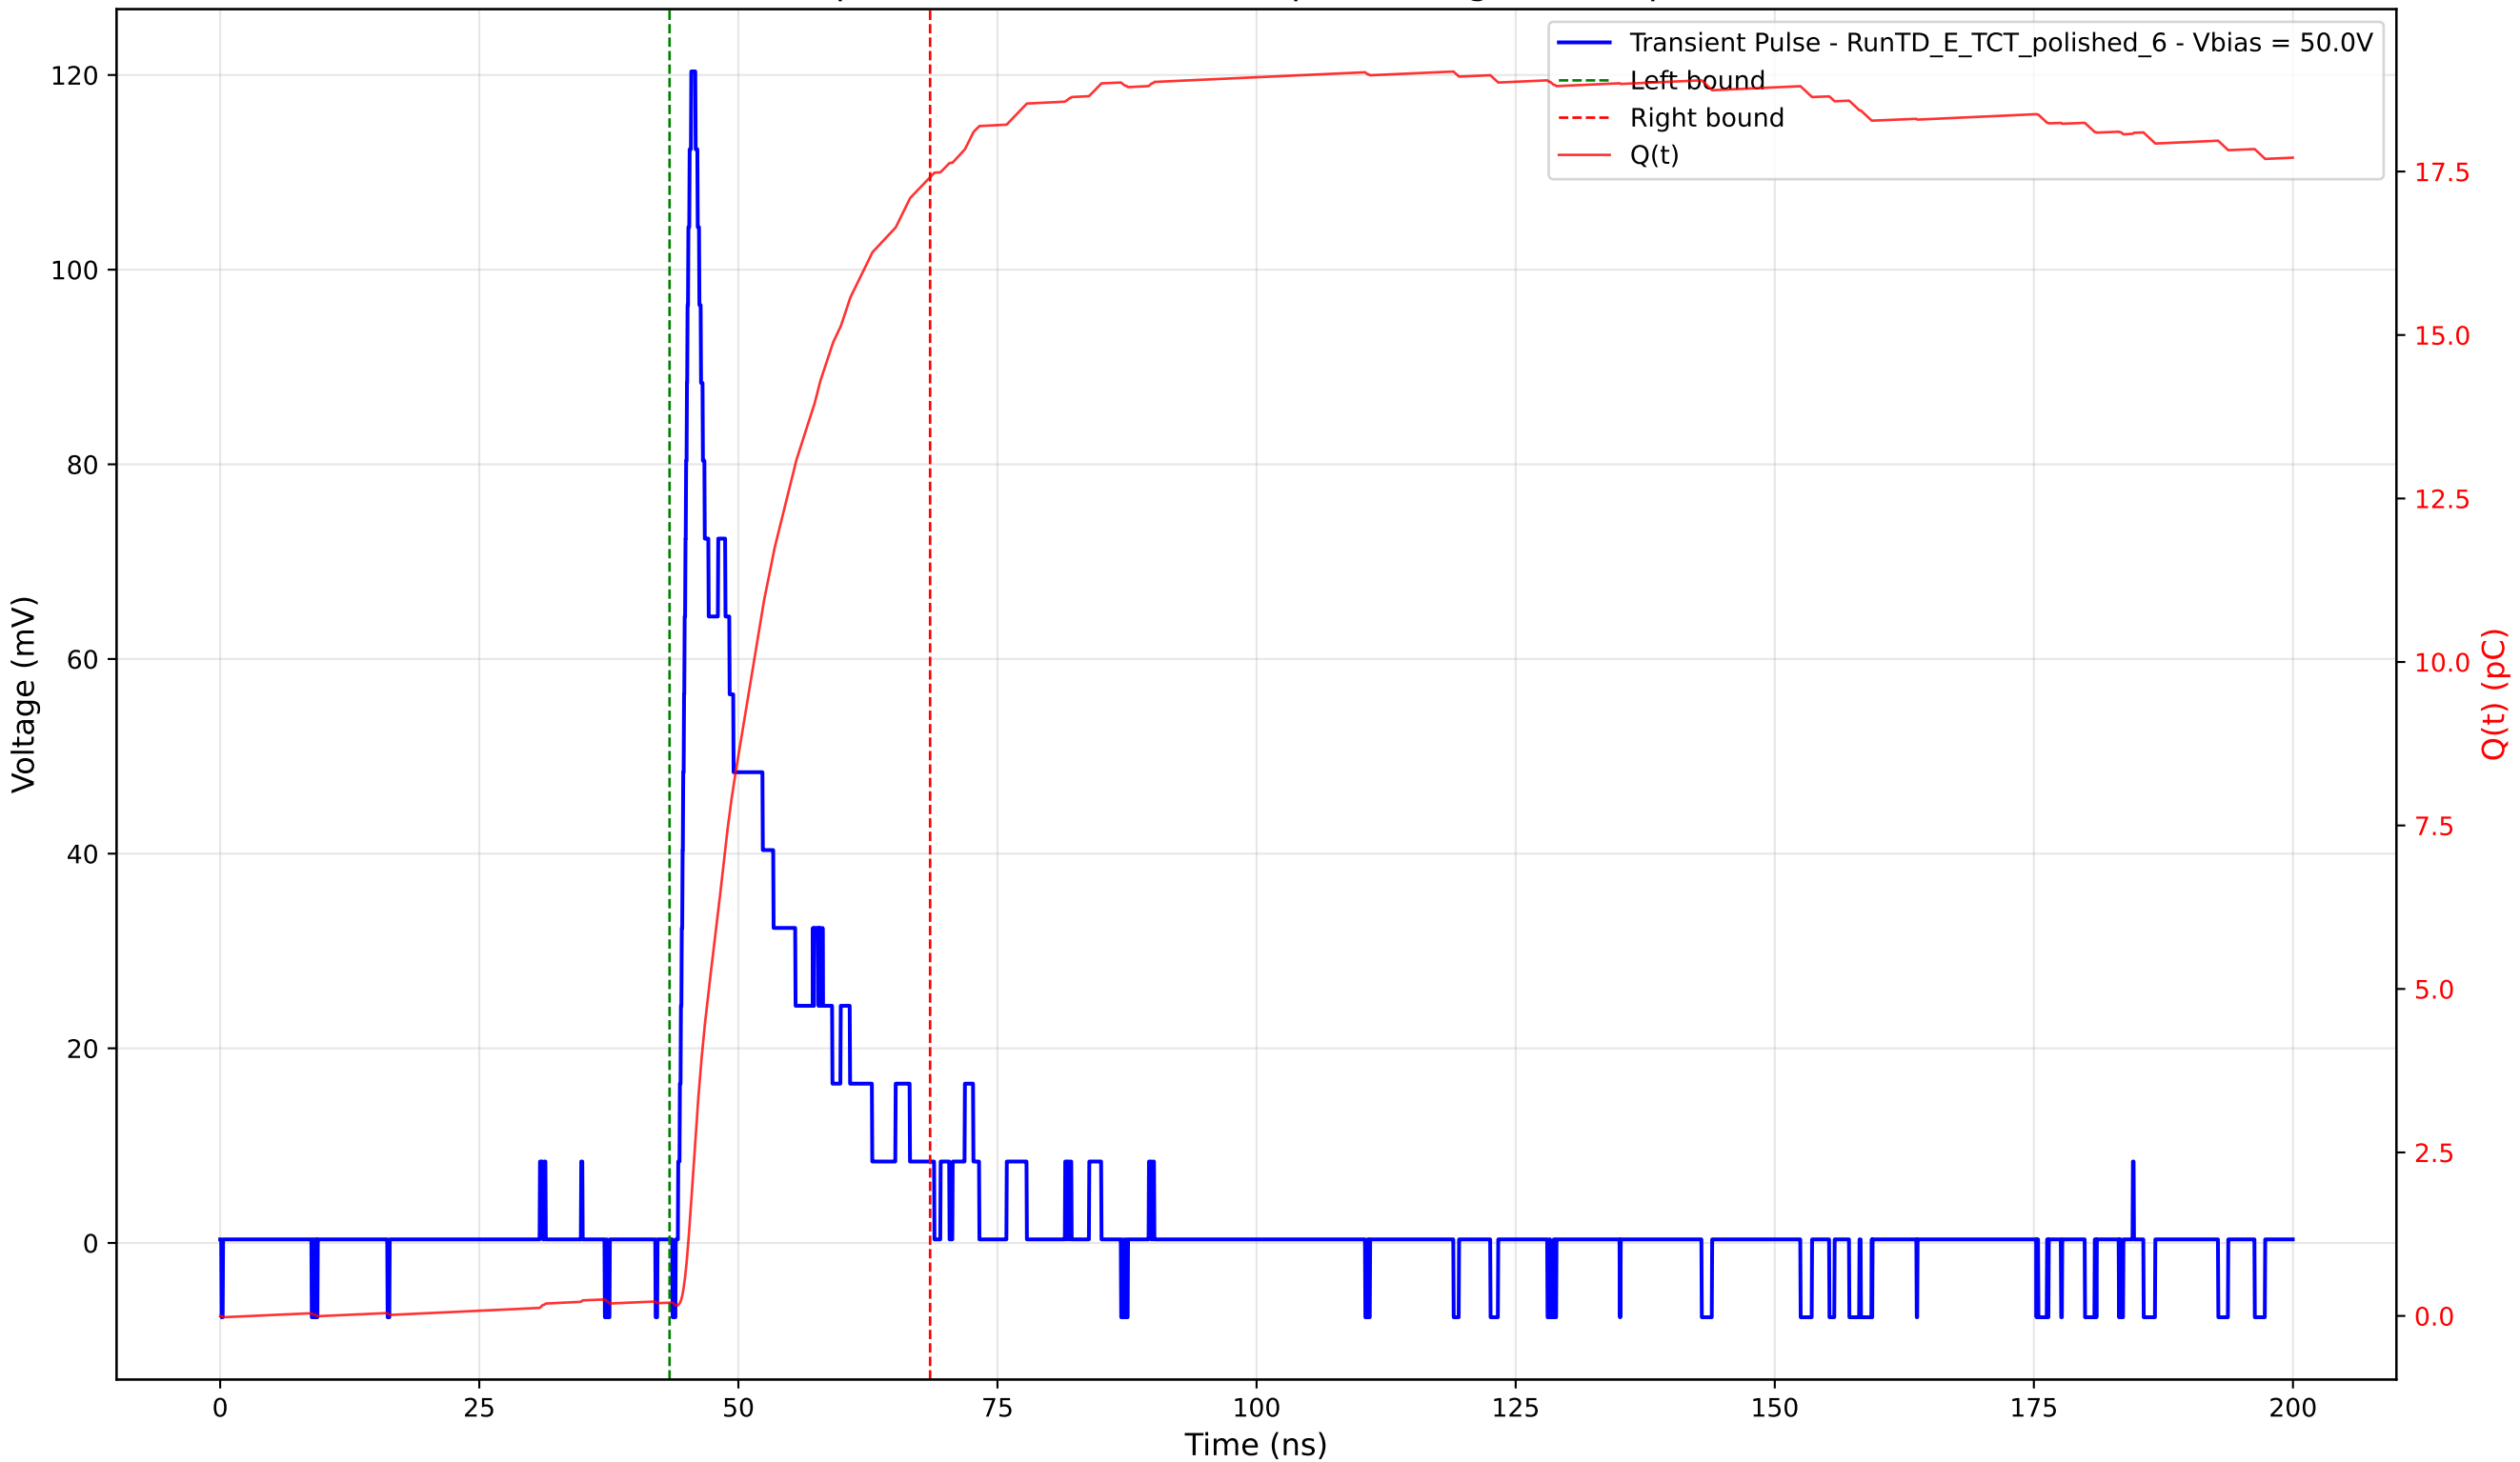


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 24.16 pC - Rise Time: 0.98 ns

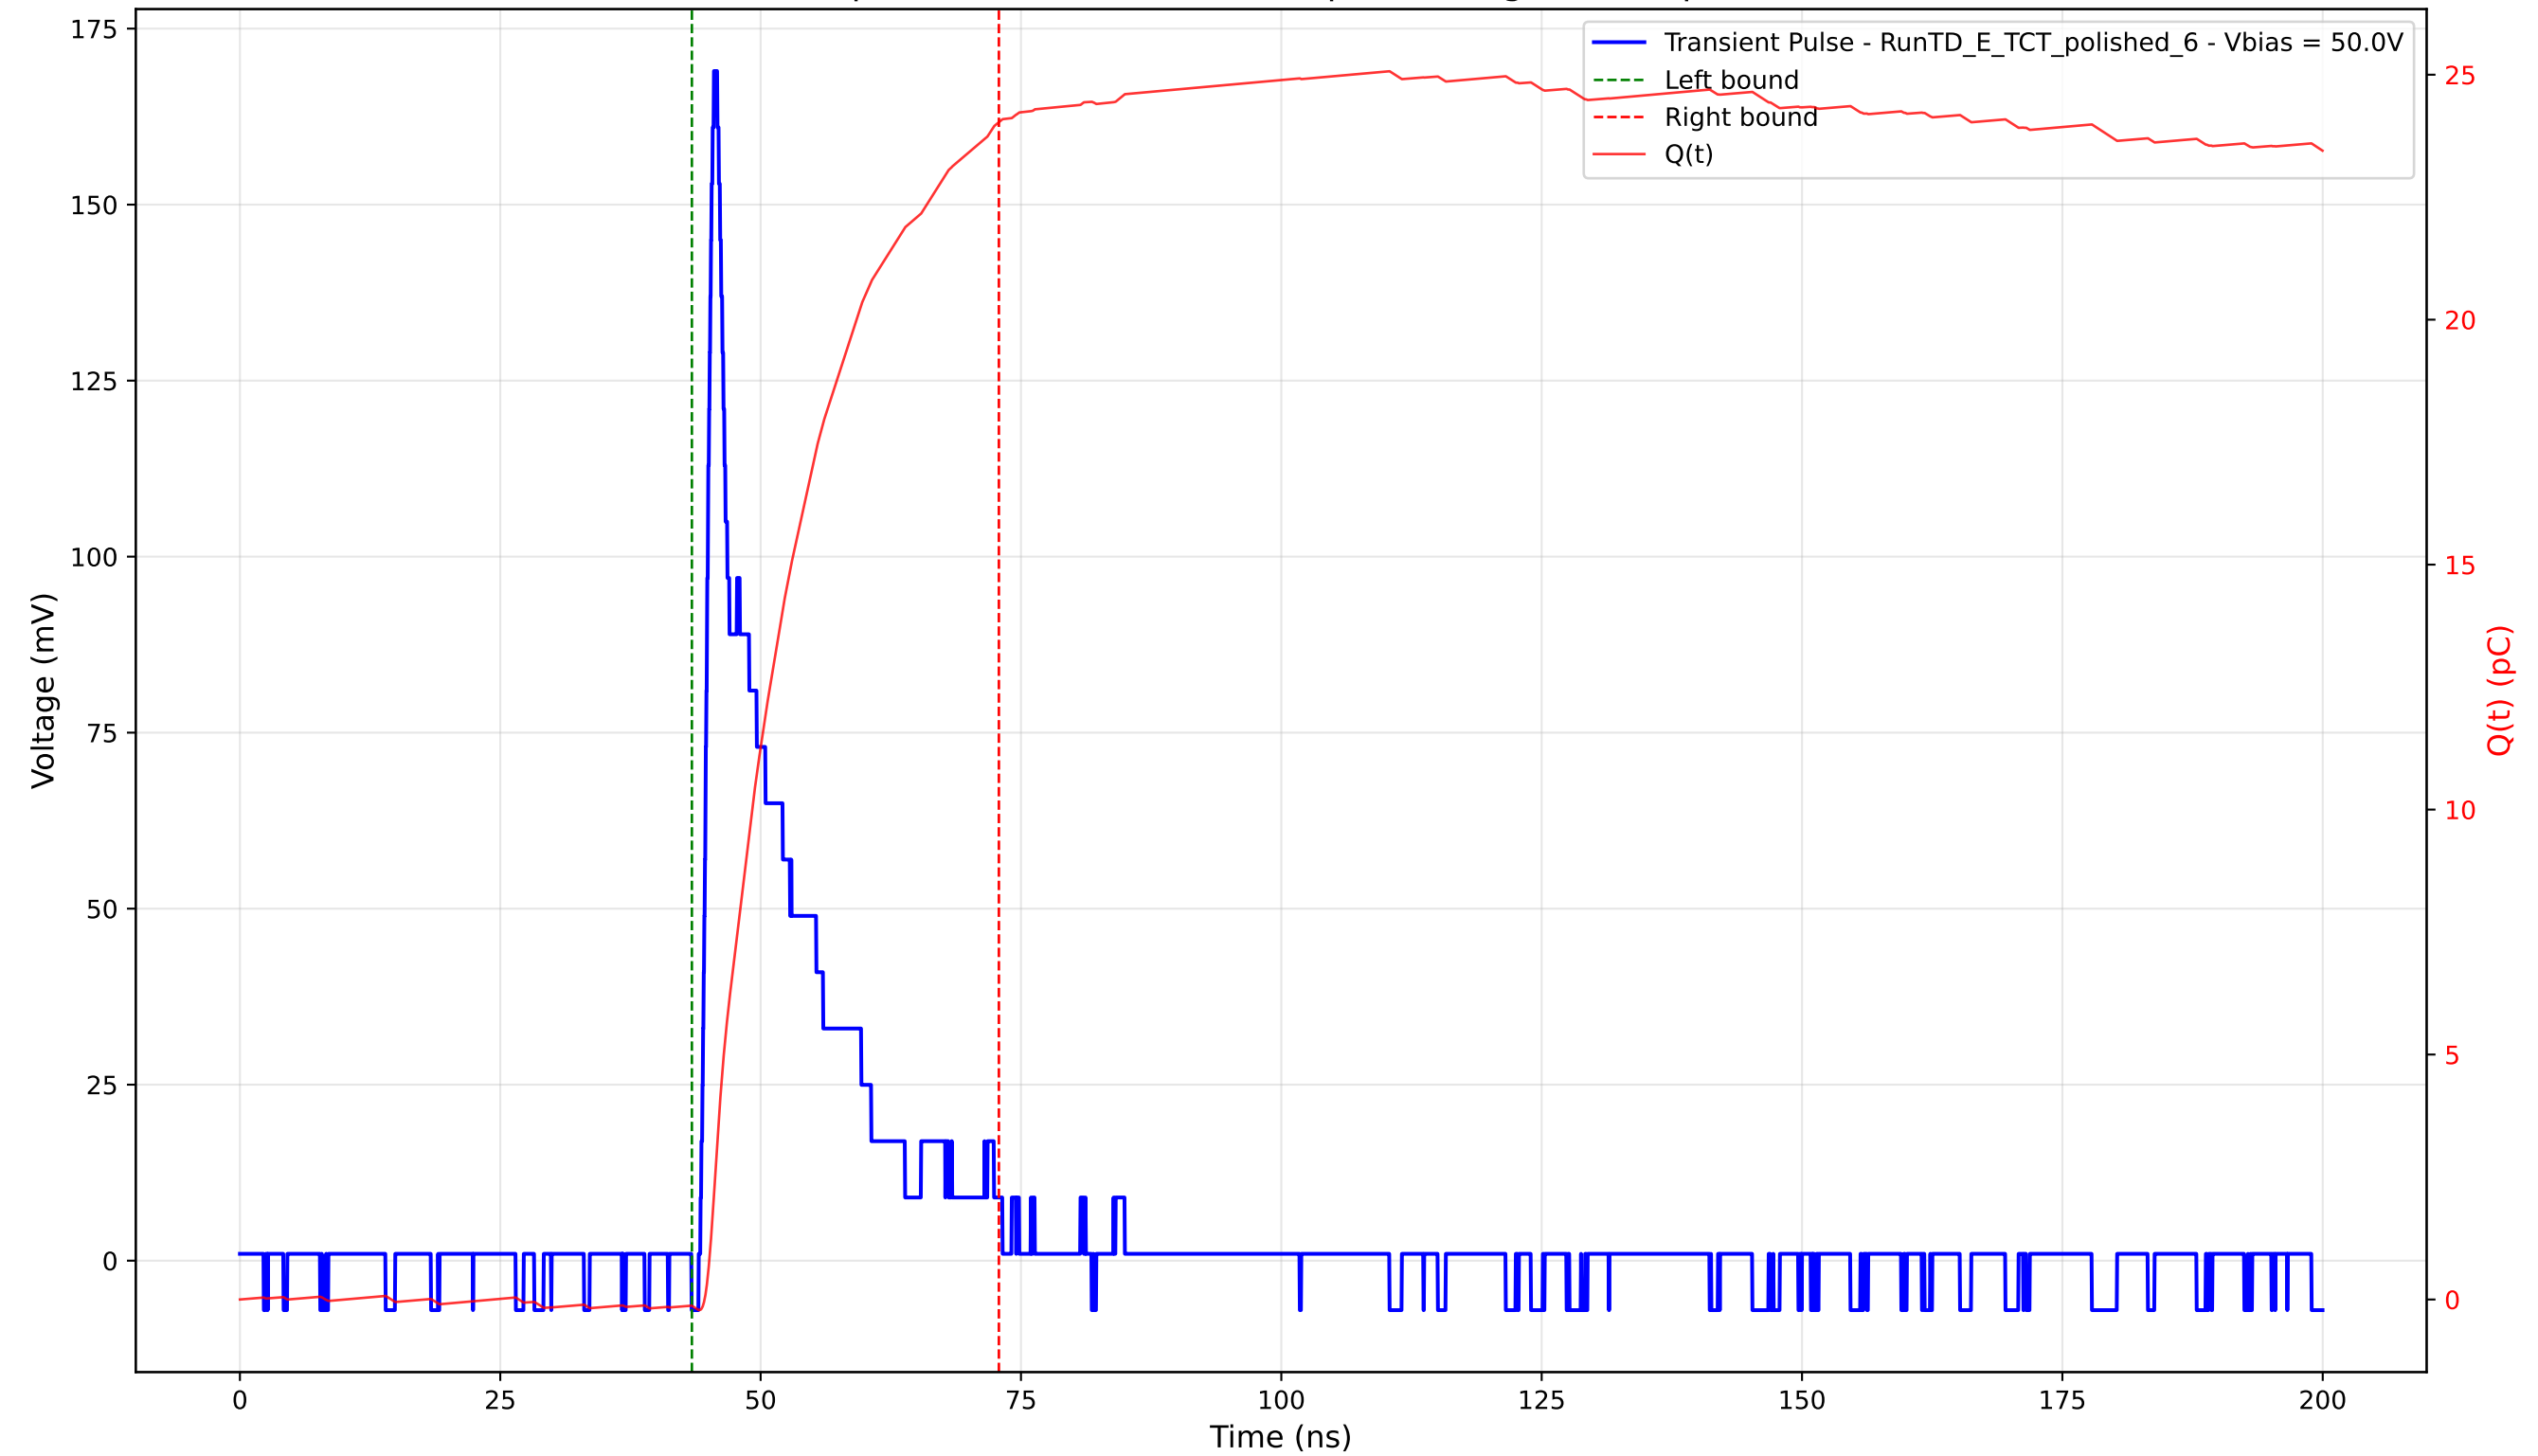


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 32.37 pC - Rise Time: 0.95 ns

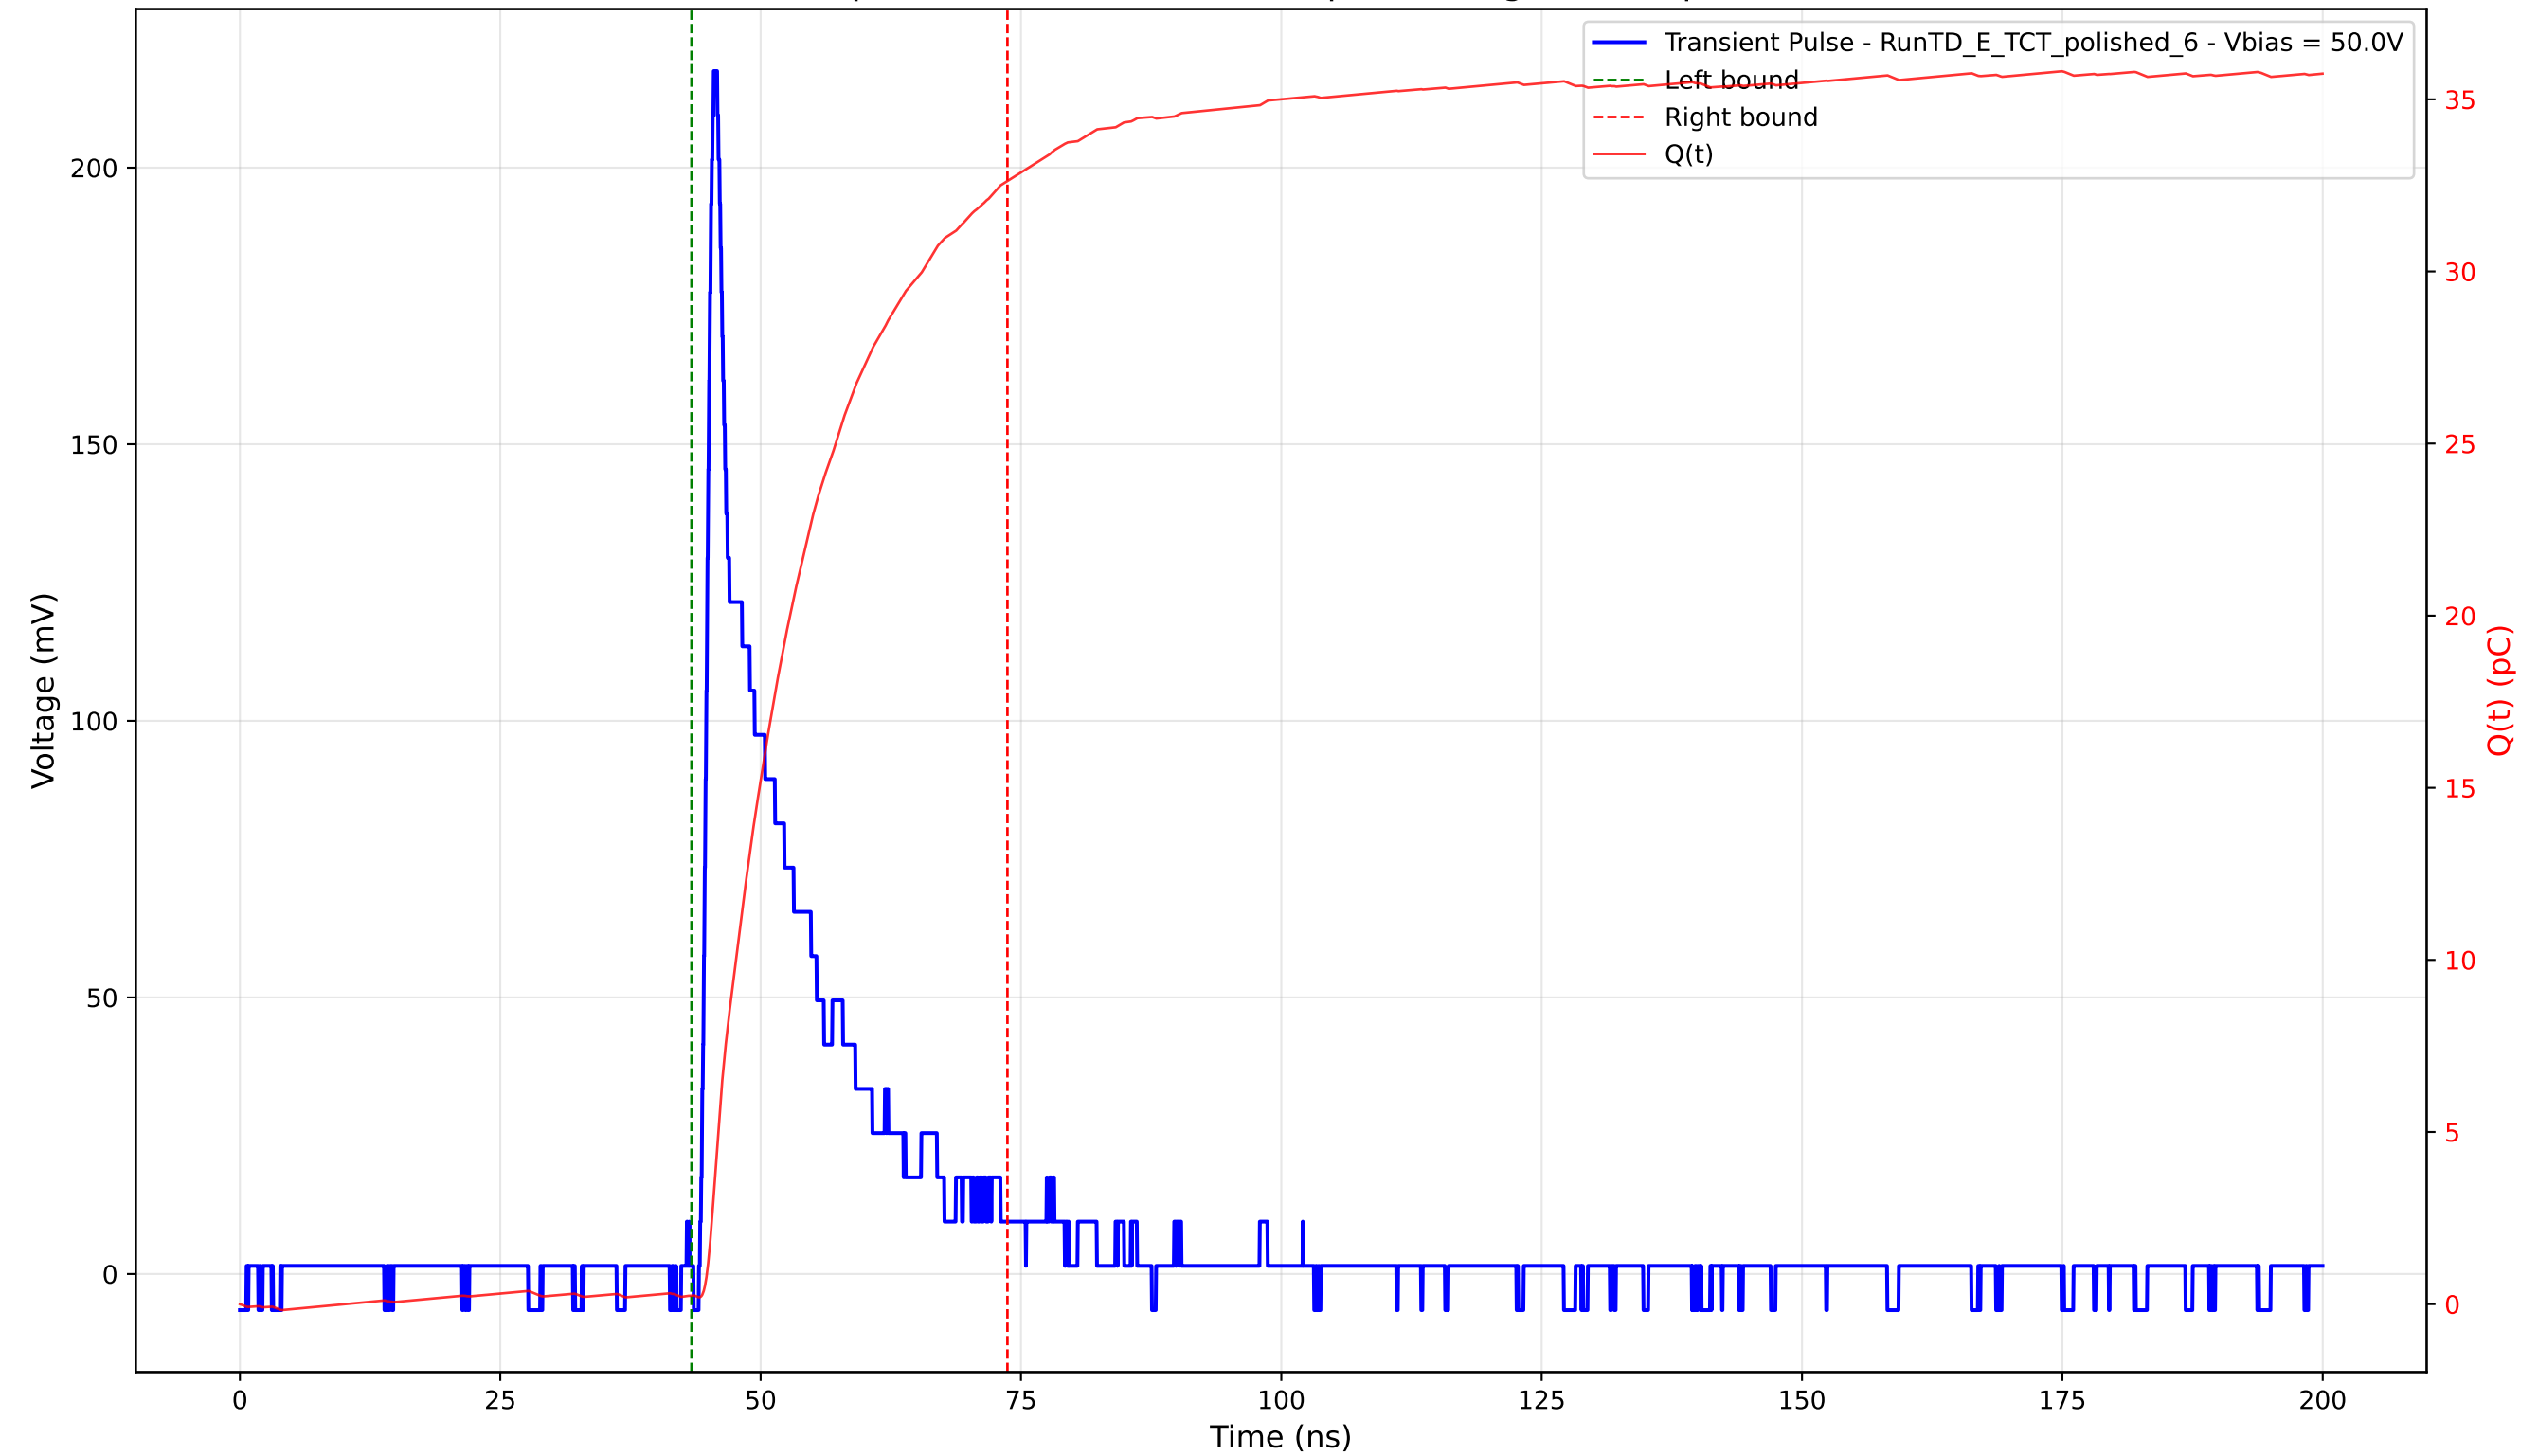


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 40.96 pC - Rise Time: 1.02 ns

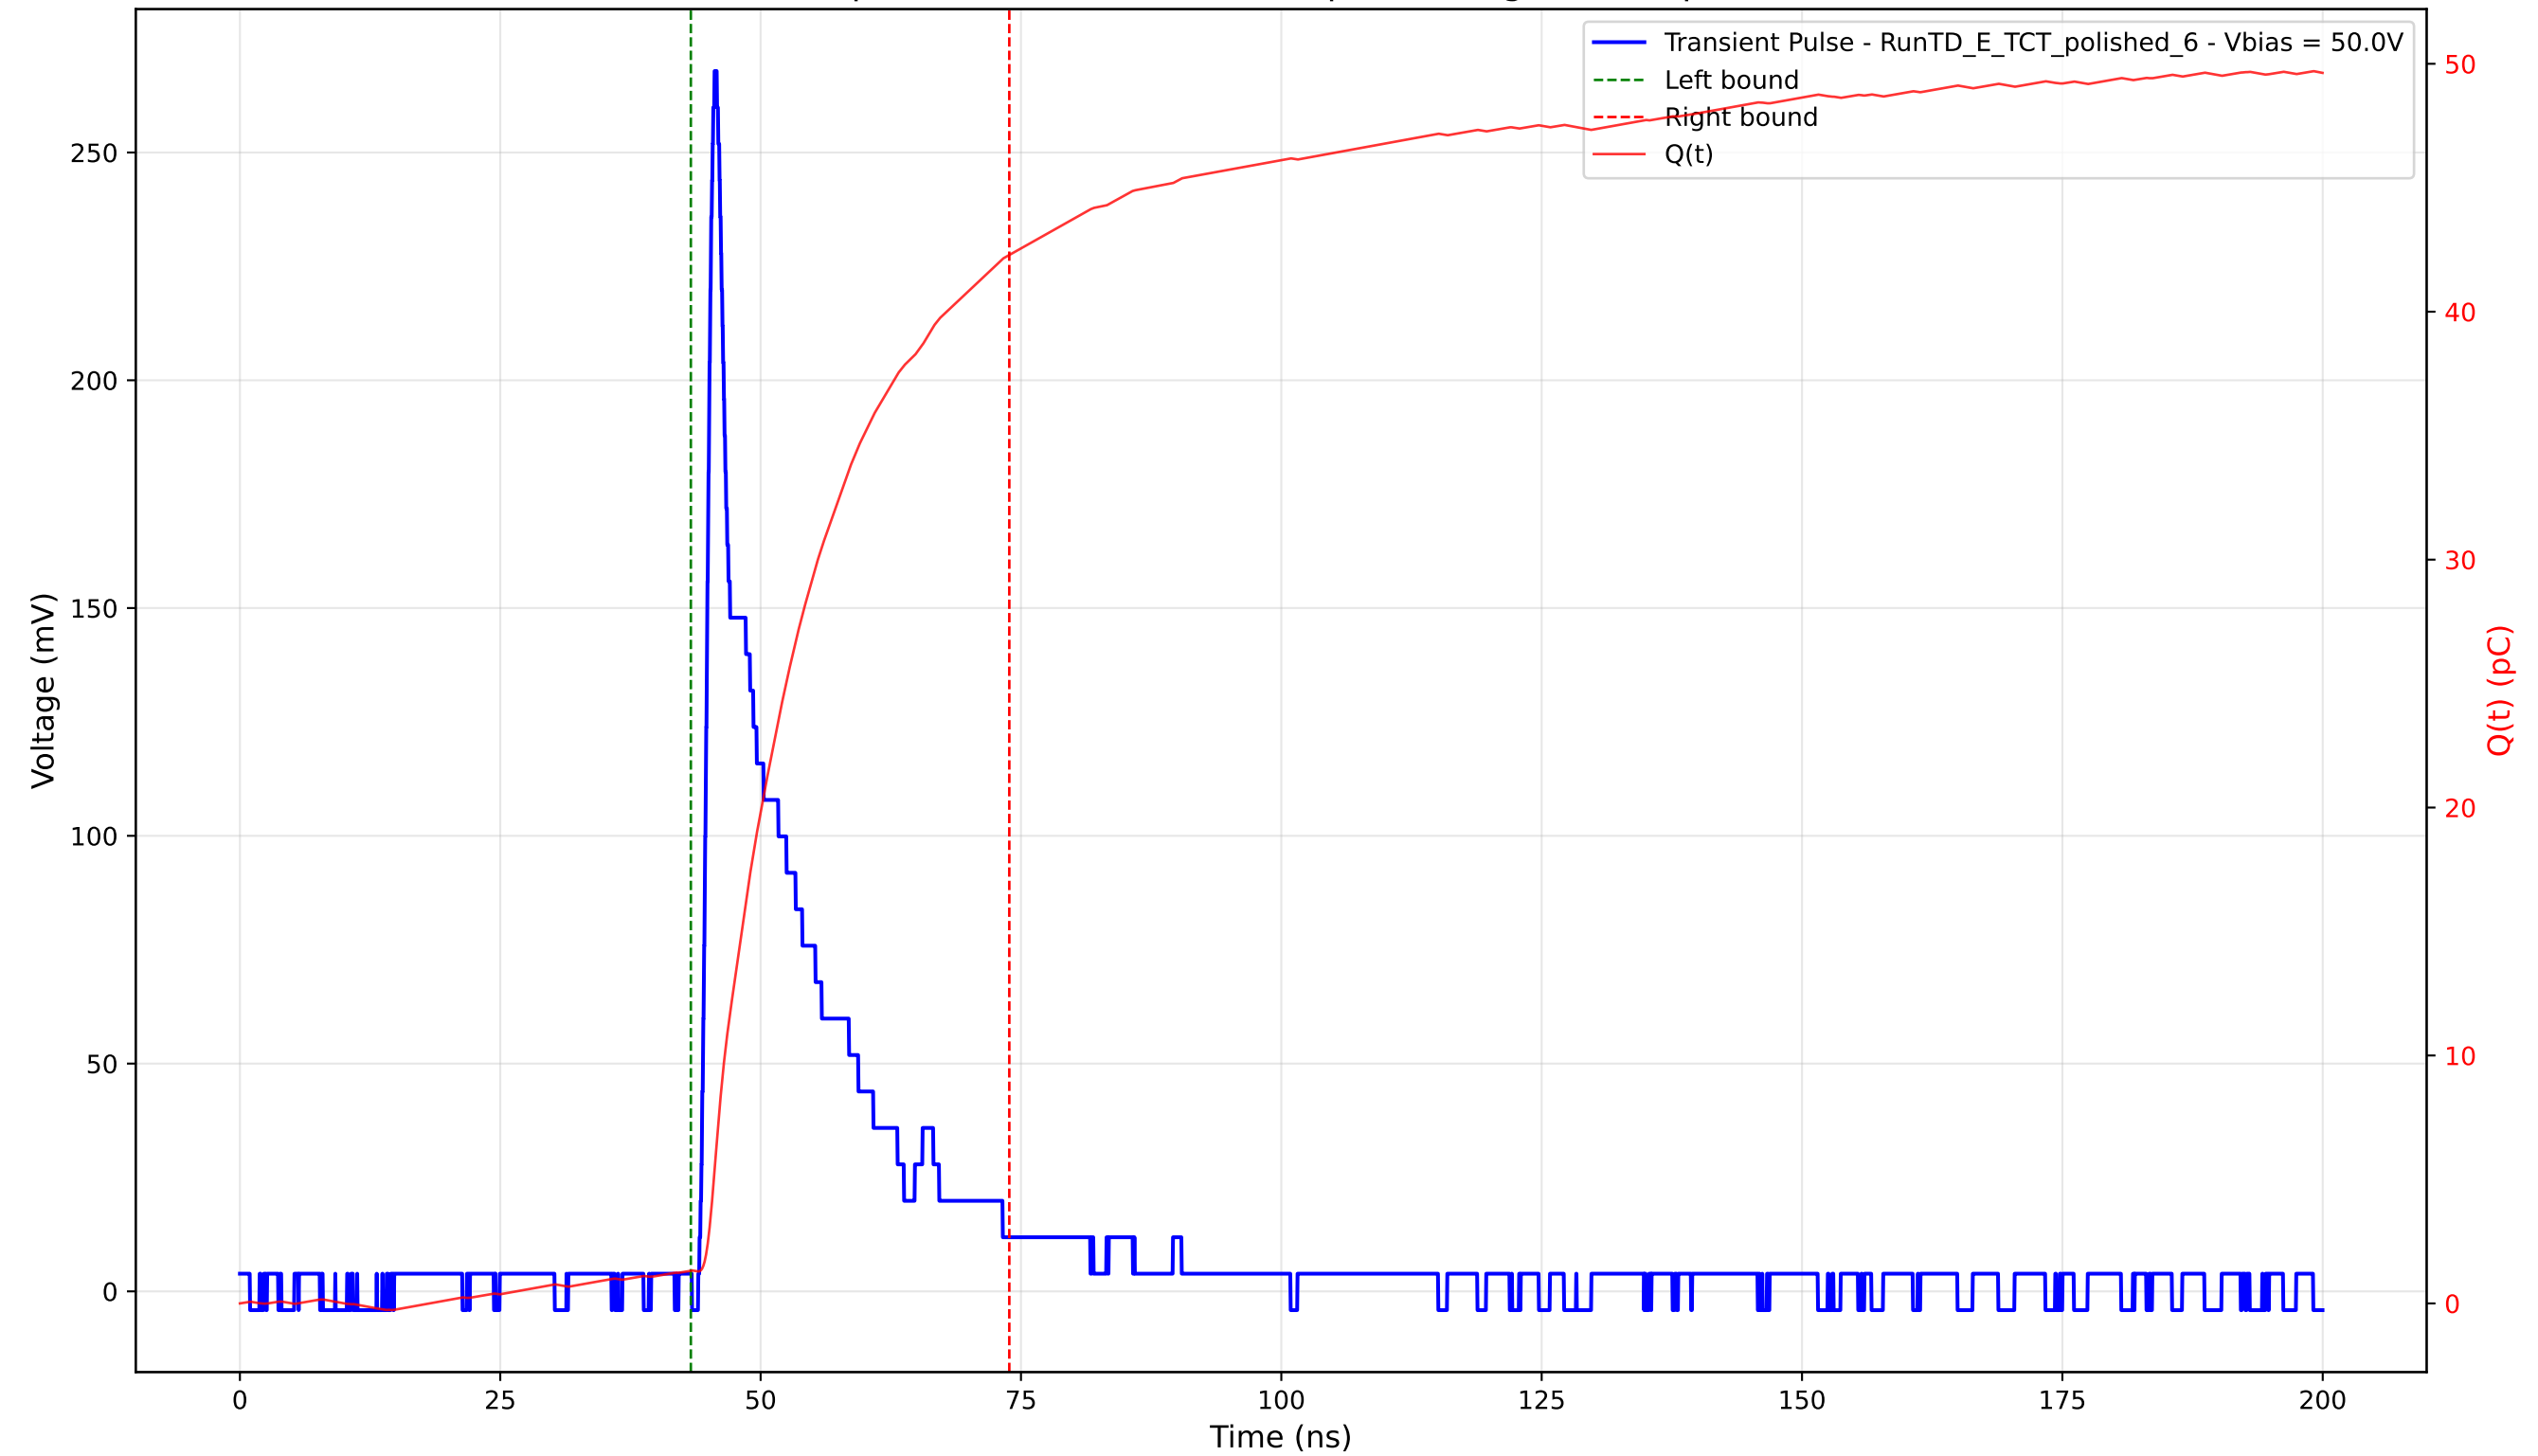


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 44.09 pC - Rise Time: 1.01 ns

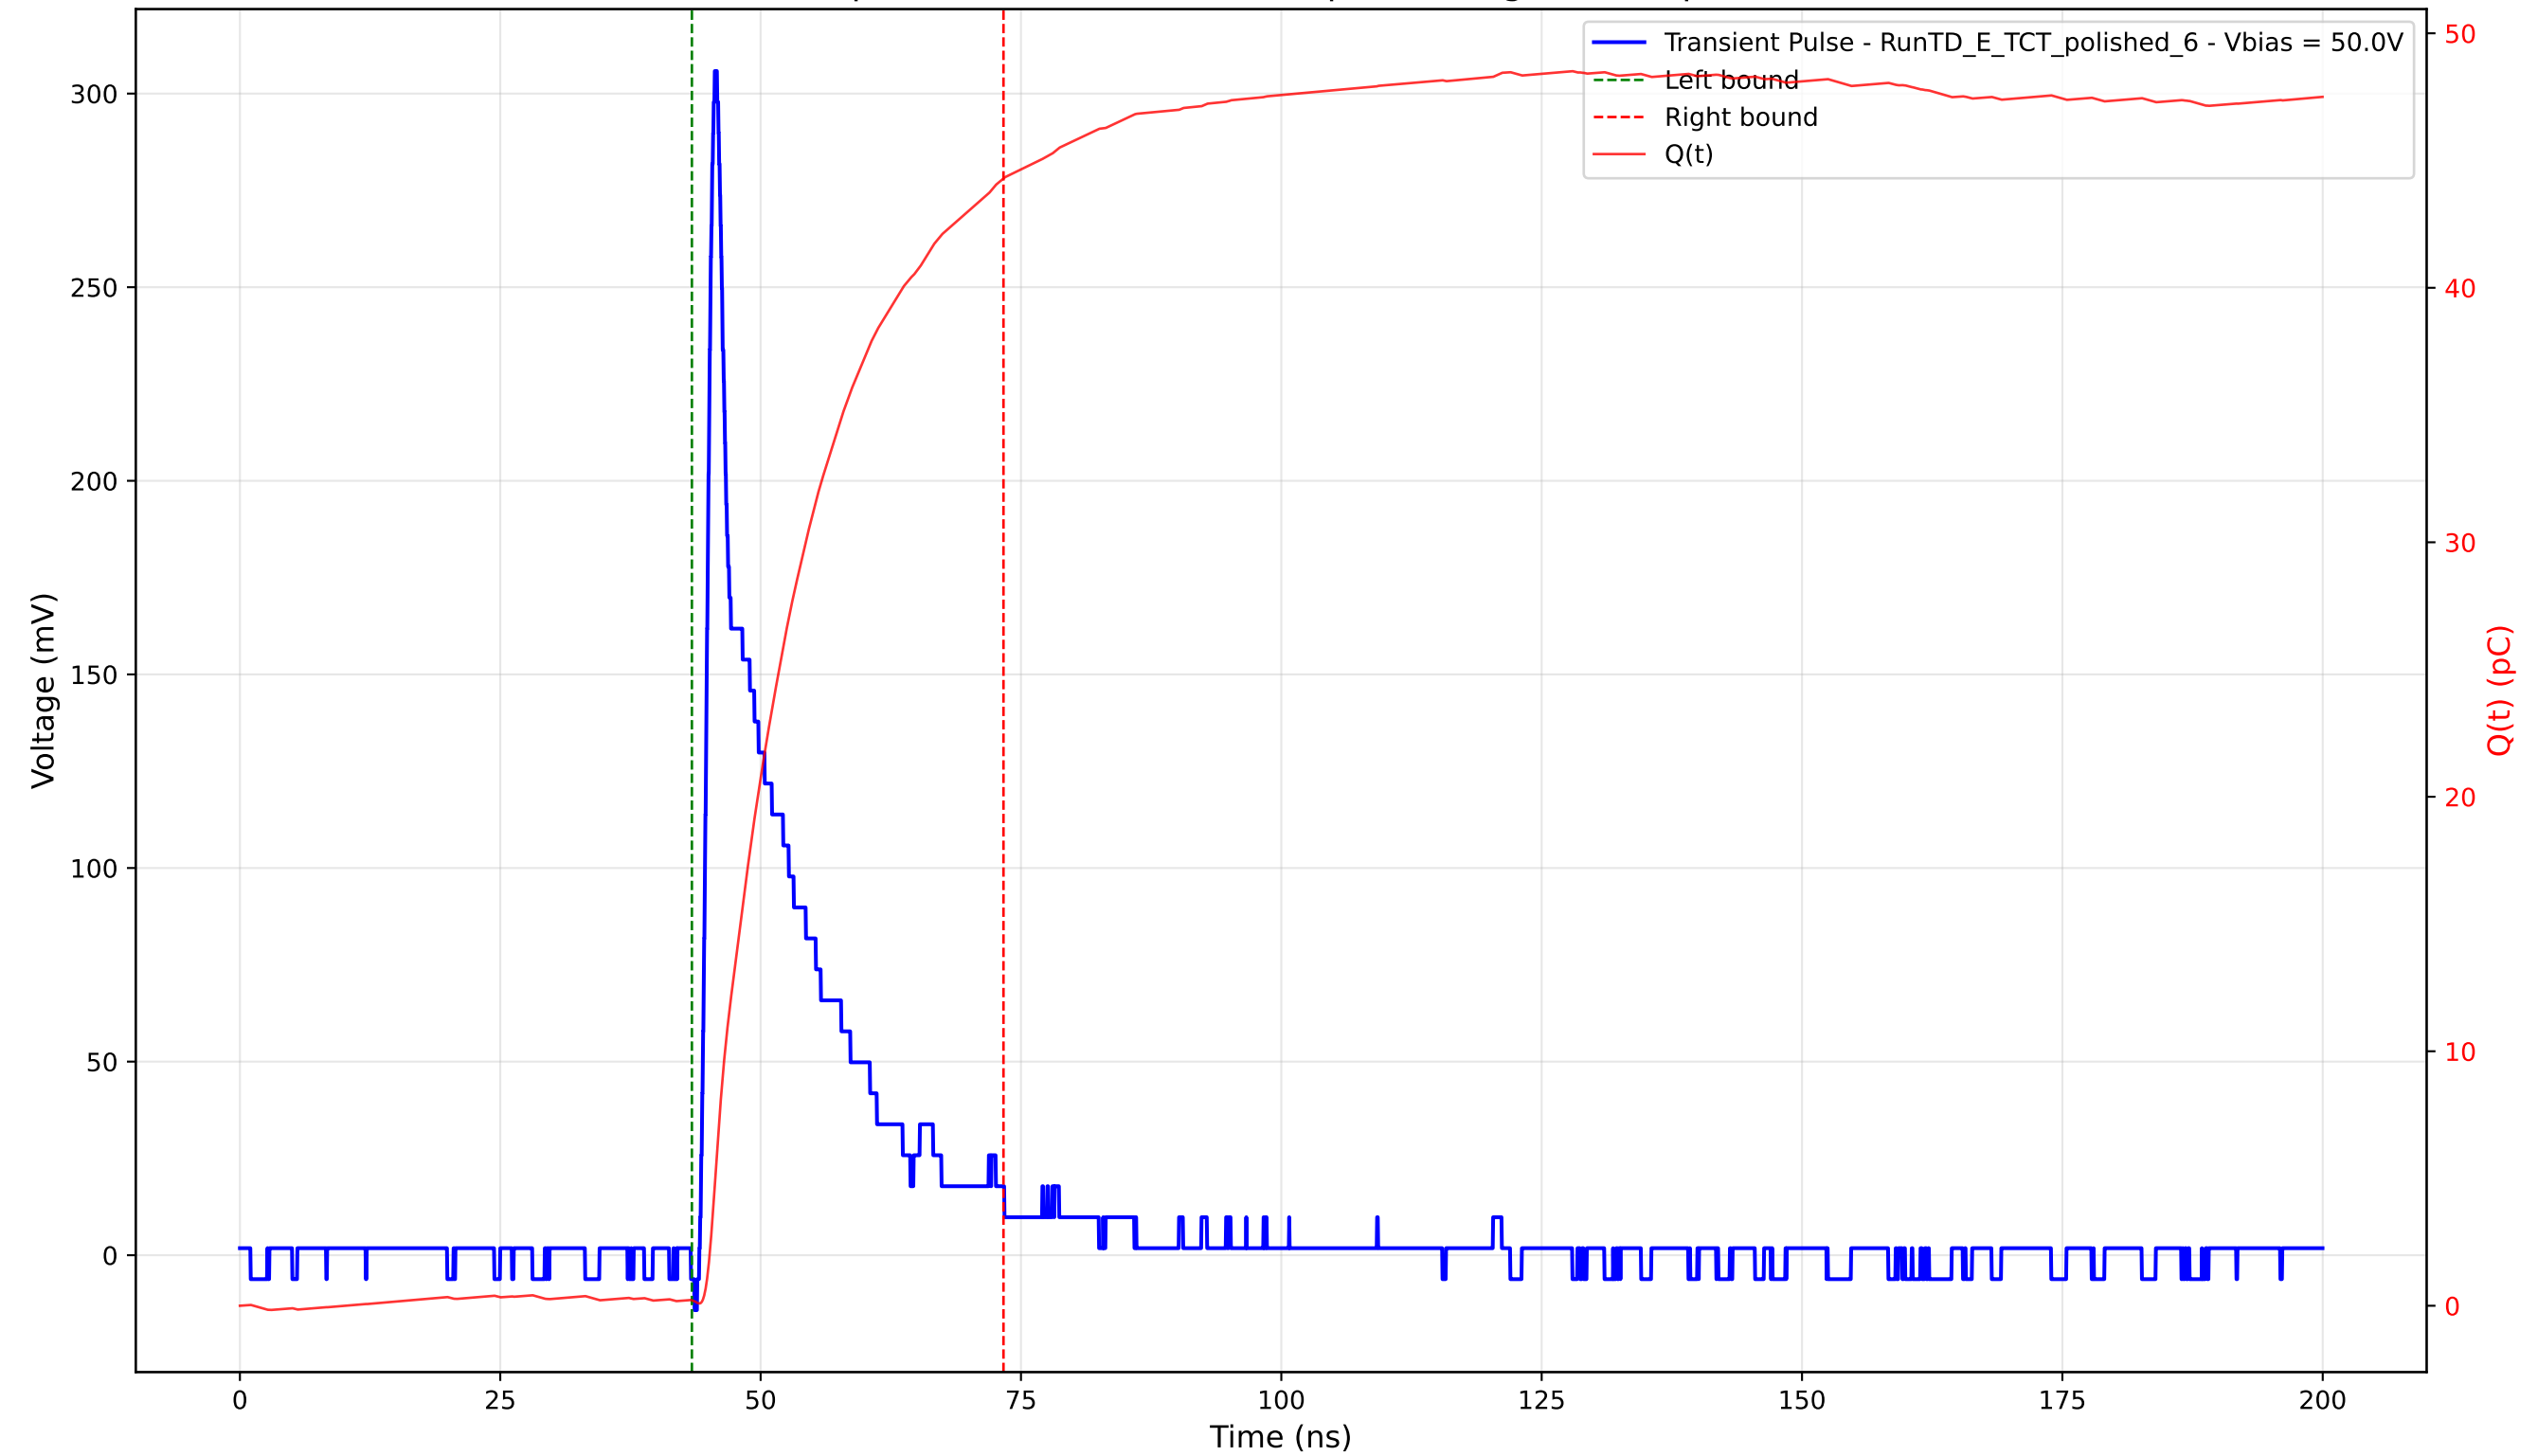


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 48.52 pC - Rise Time: 1.00 ns

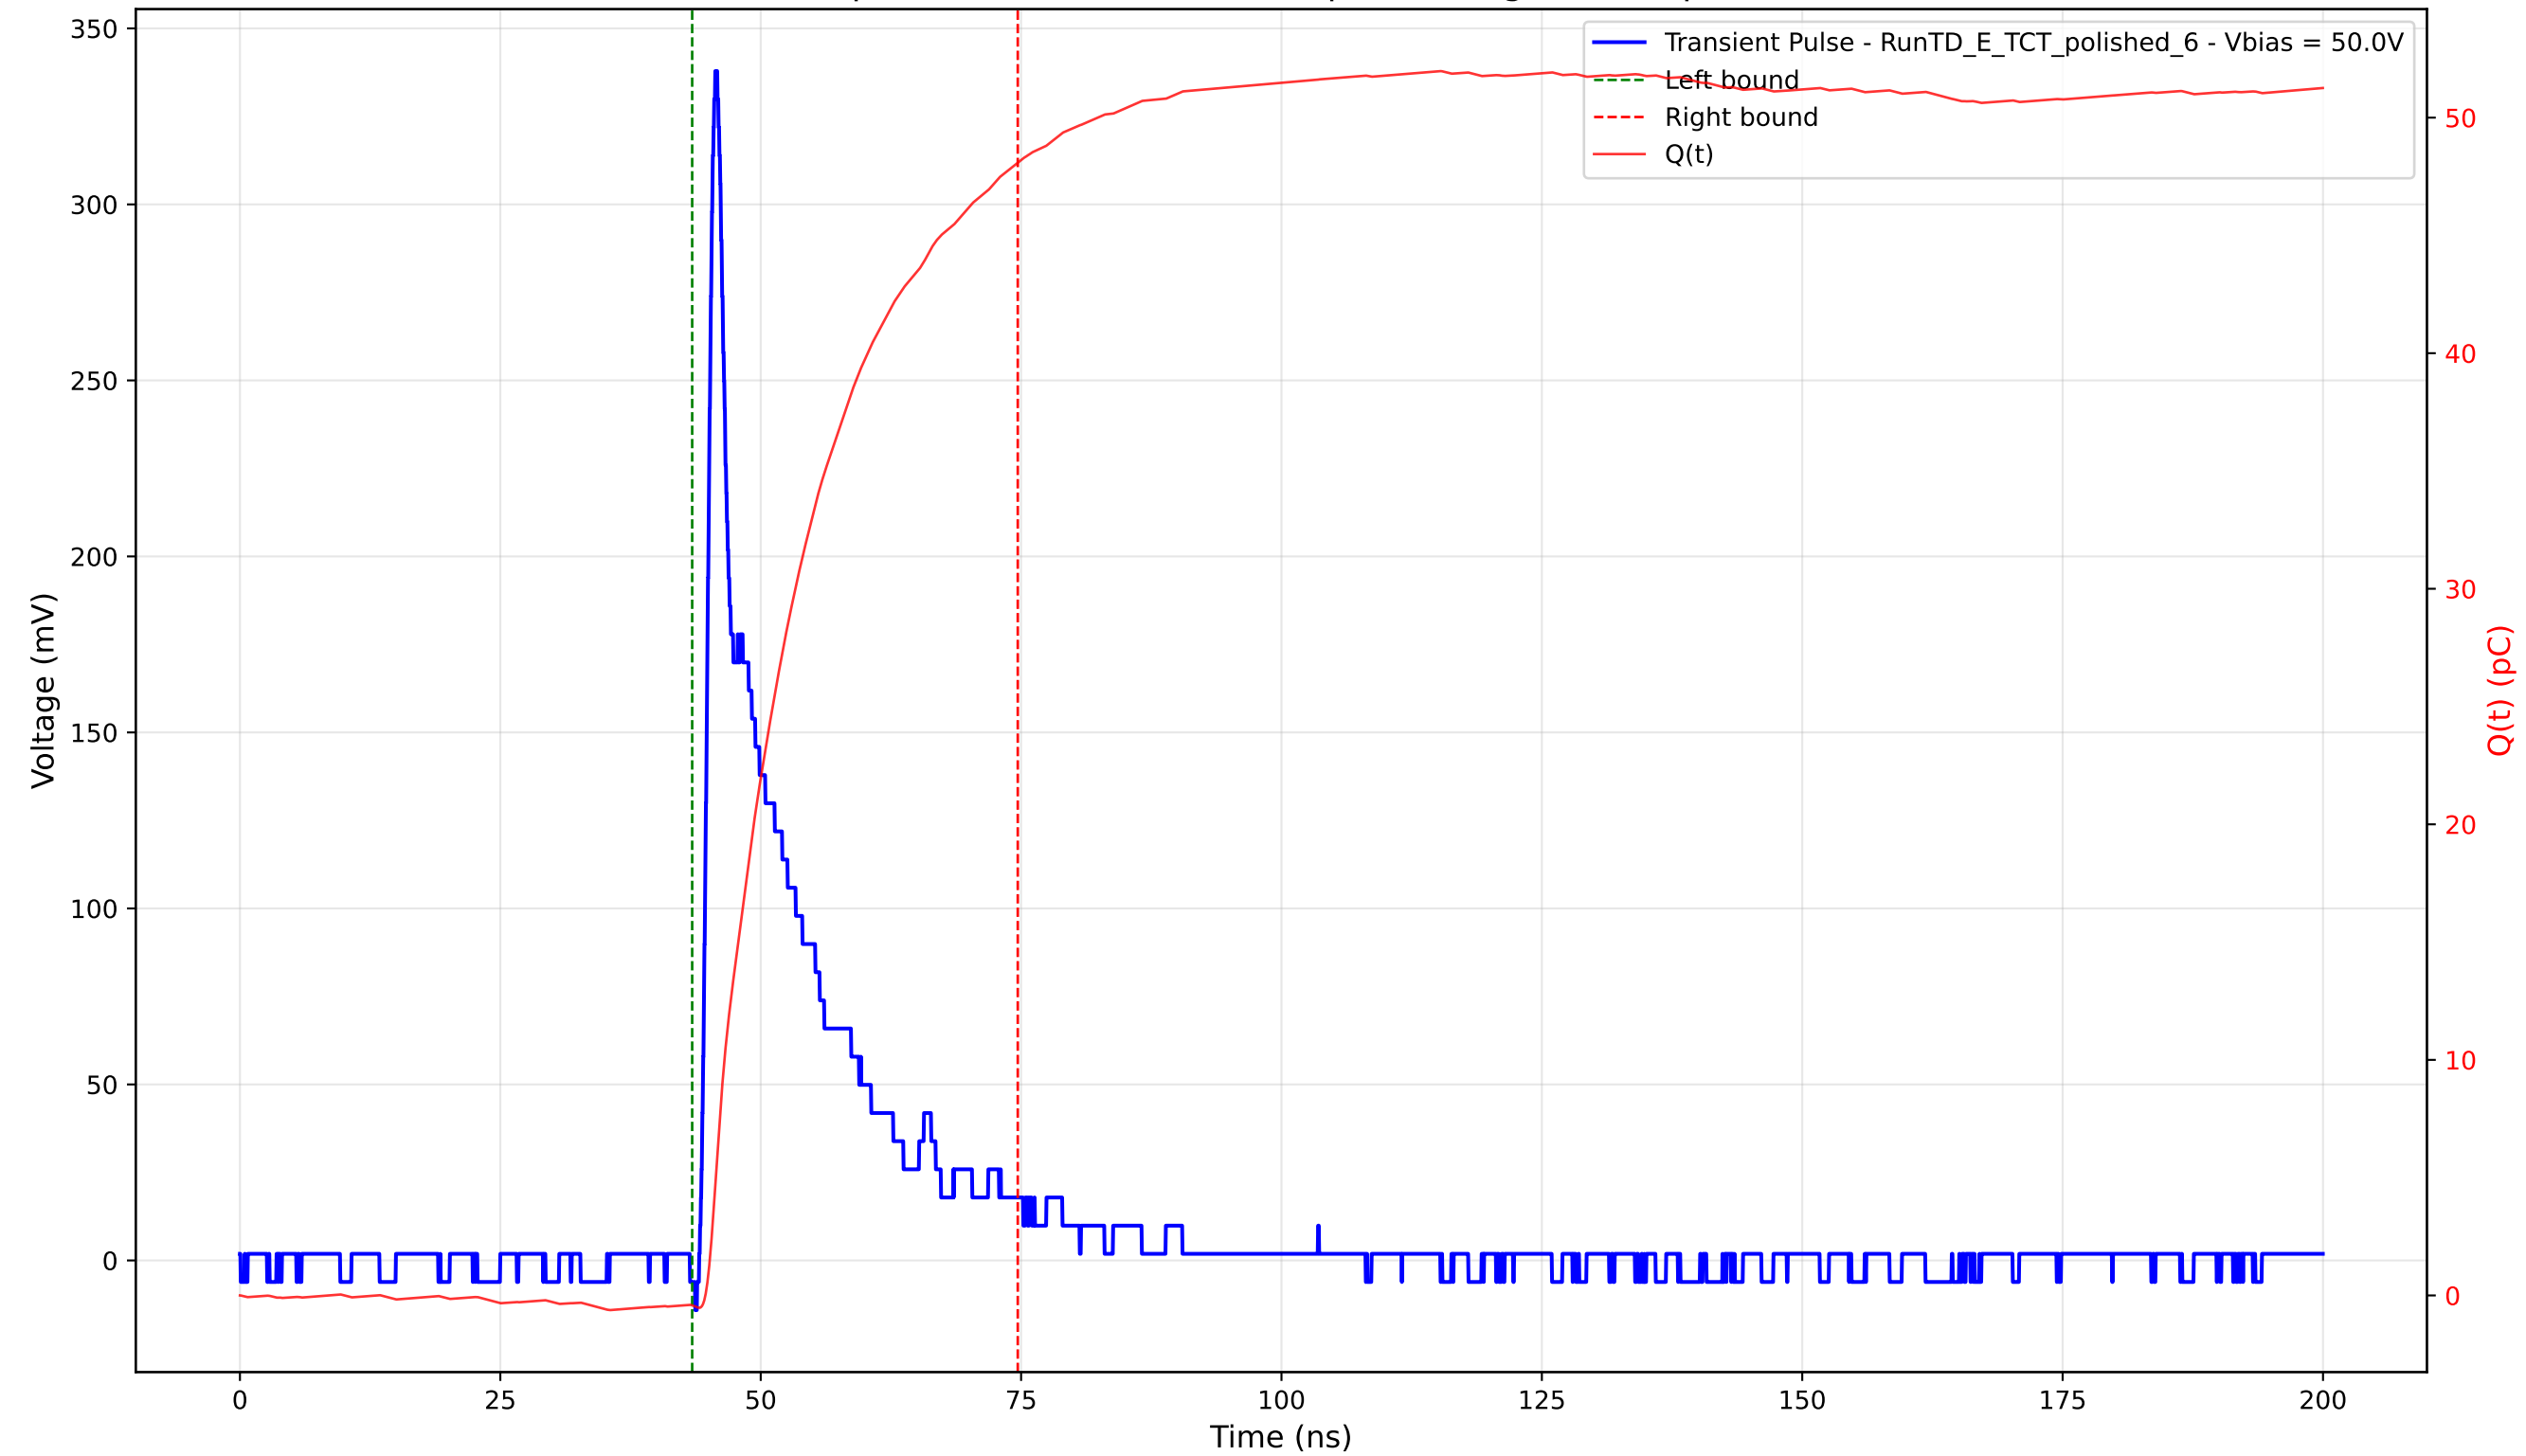


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 50.63 pC - Rise Time: 1.04 ns

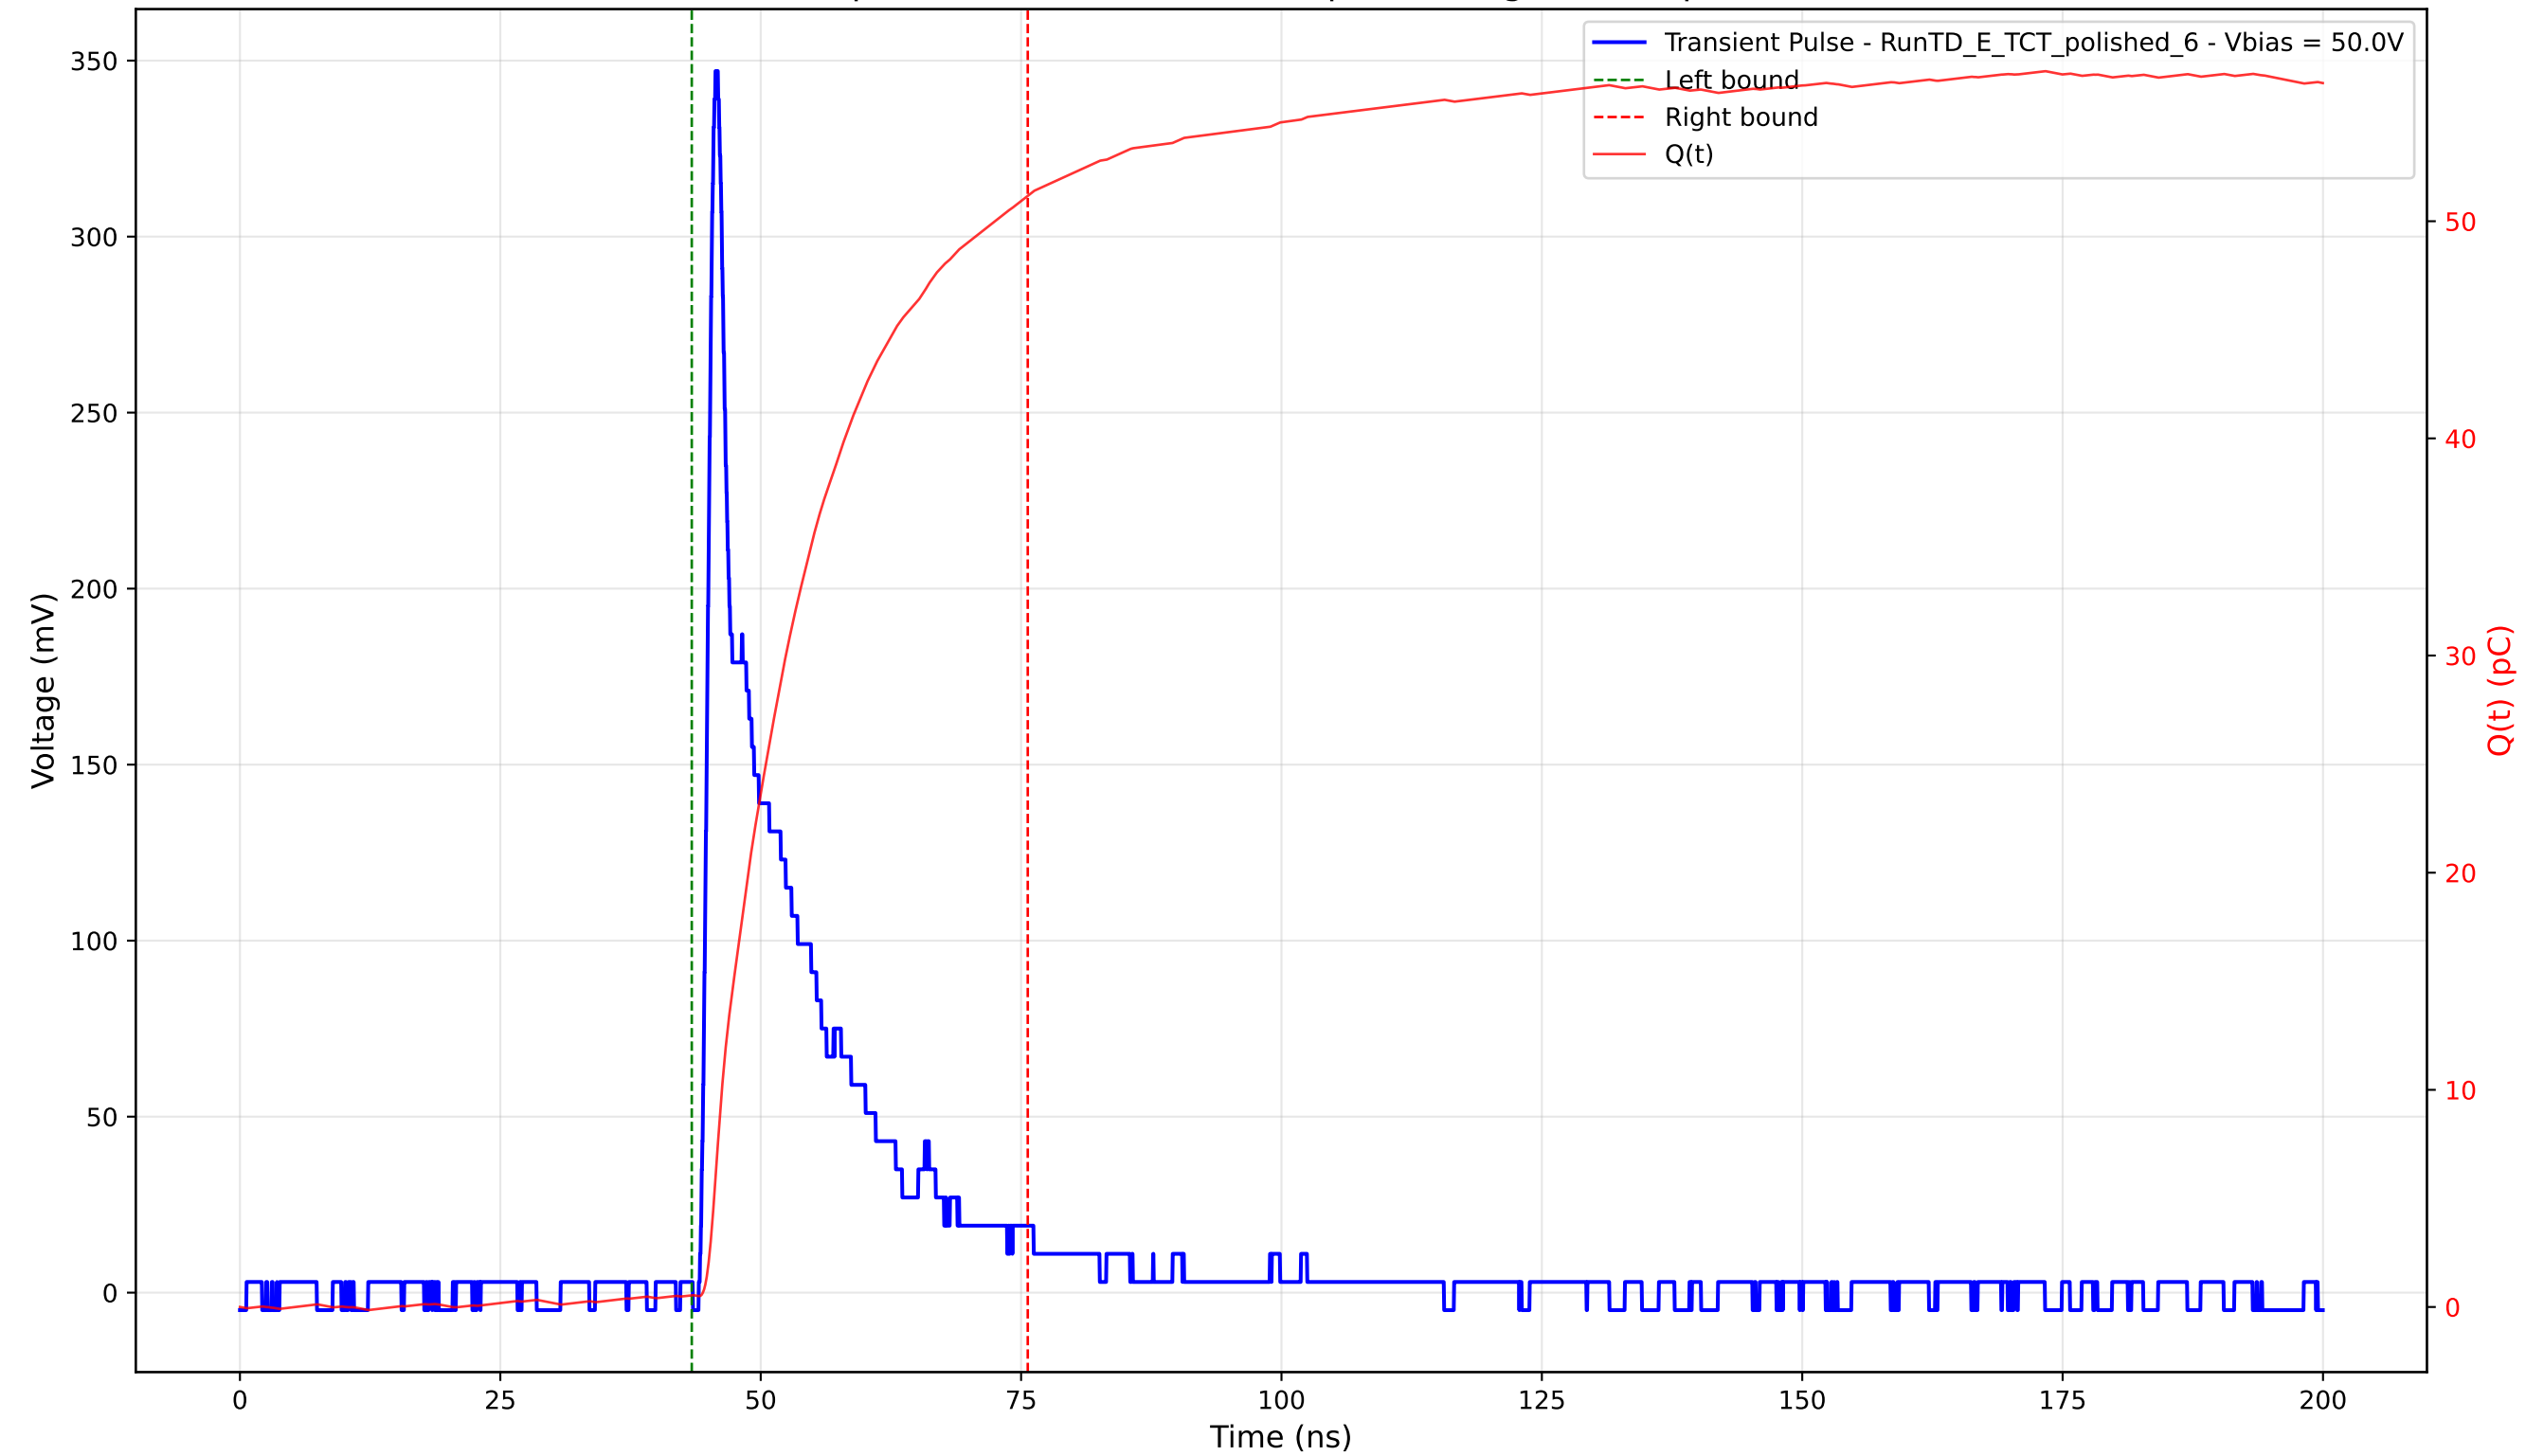


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 49.13 pC - Rise Time: 1.02 ns

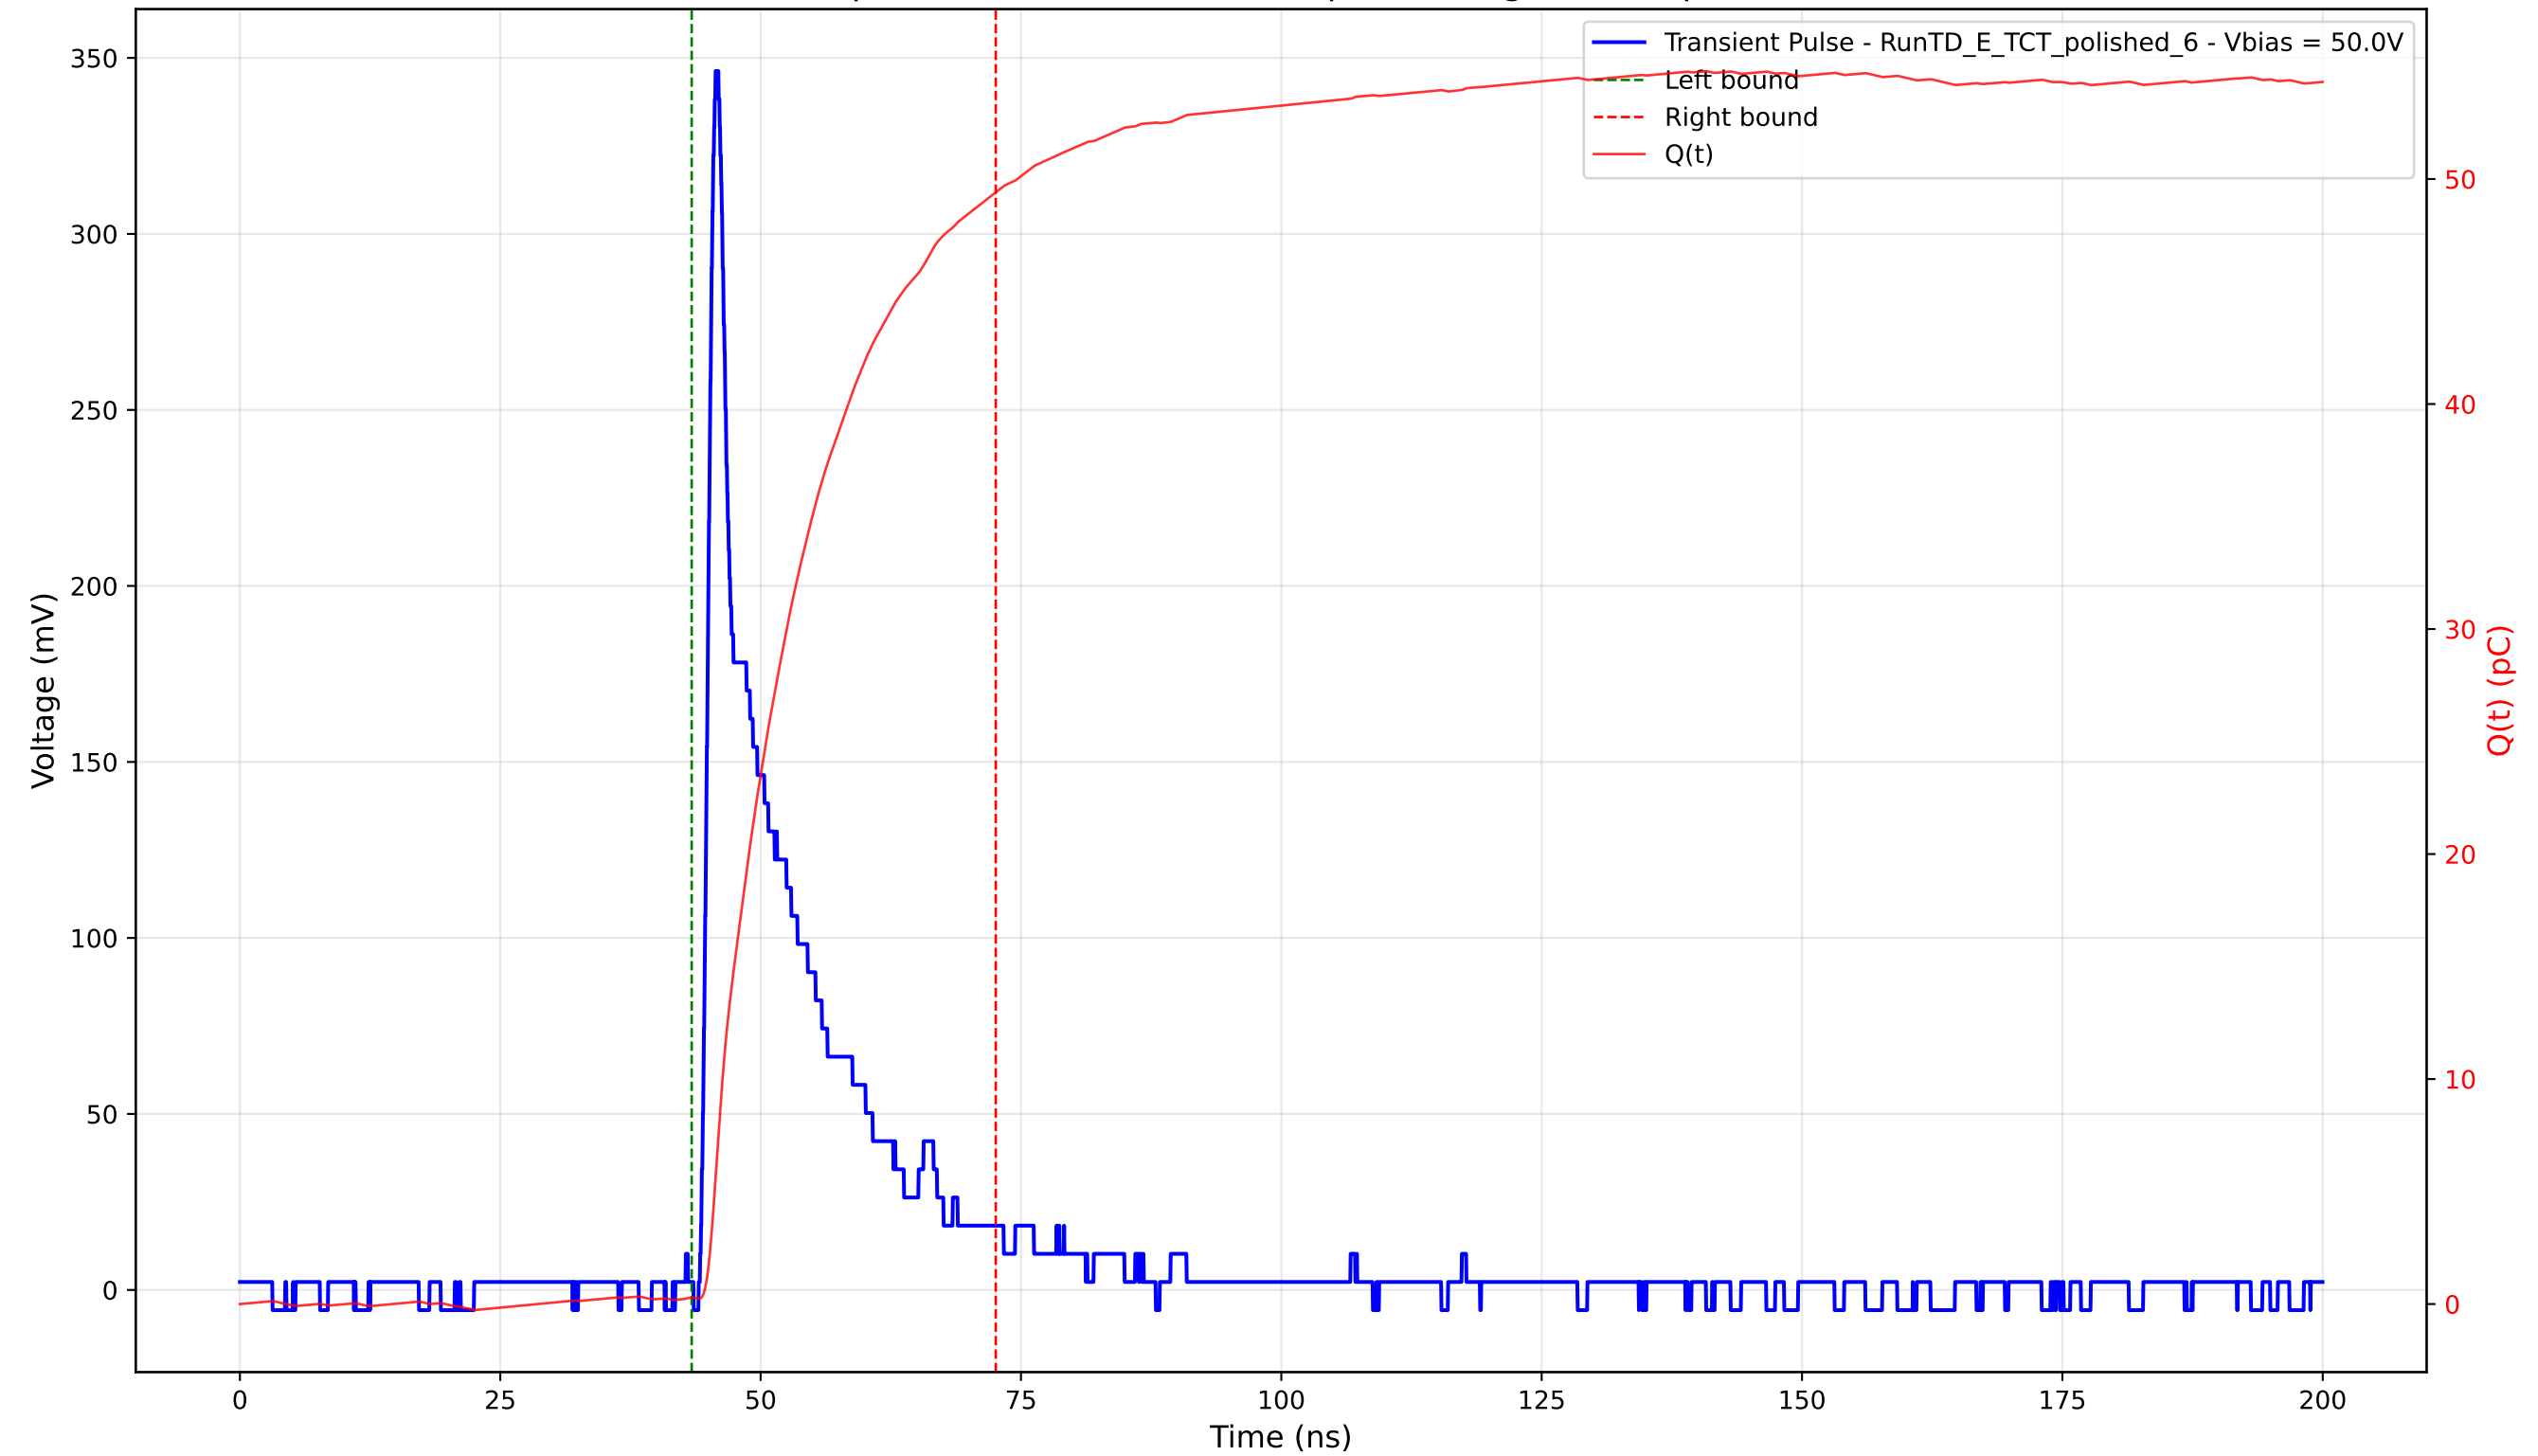


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 47.61 pC - Rise Time: 1.06 ns

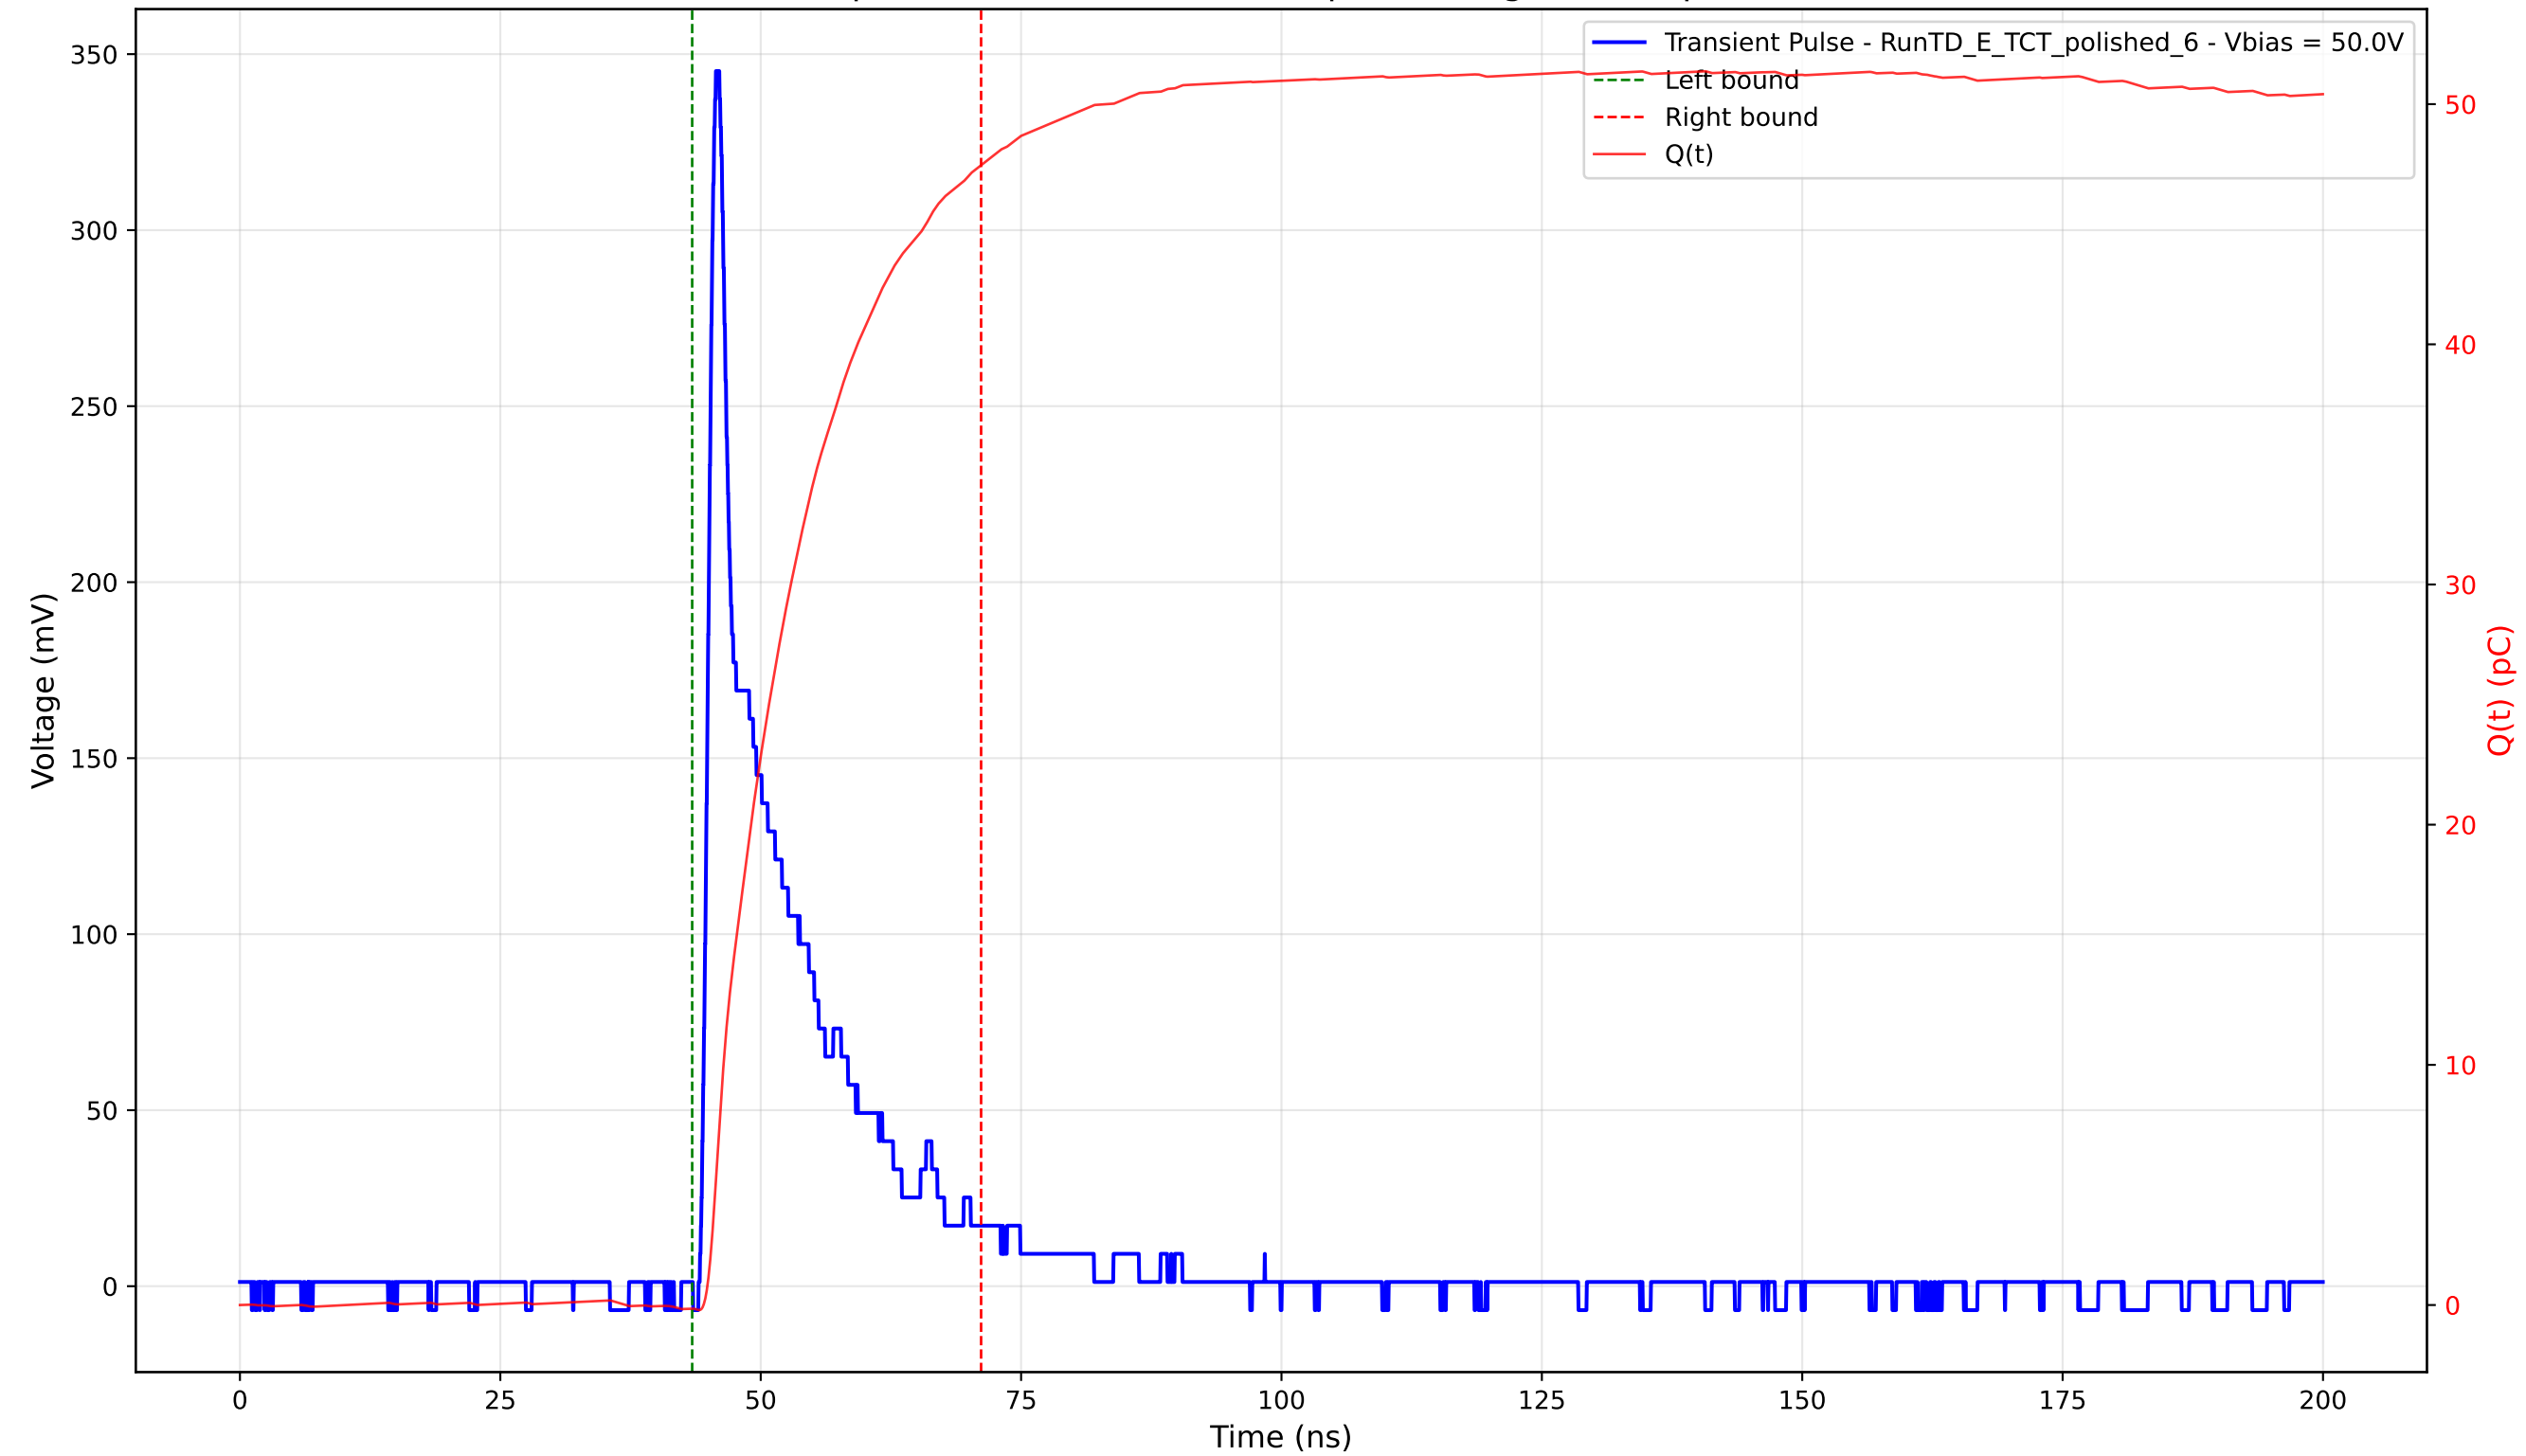


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 47.80 pC - Rise Time: 1.08 ns

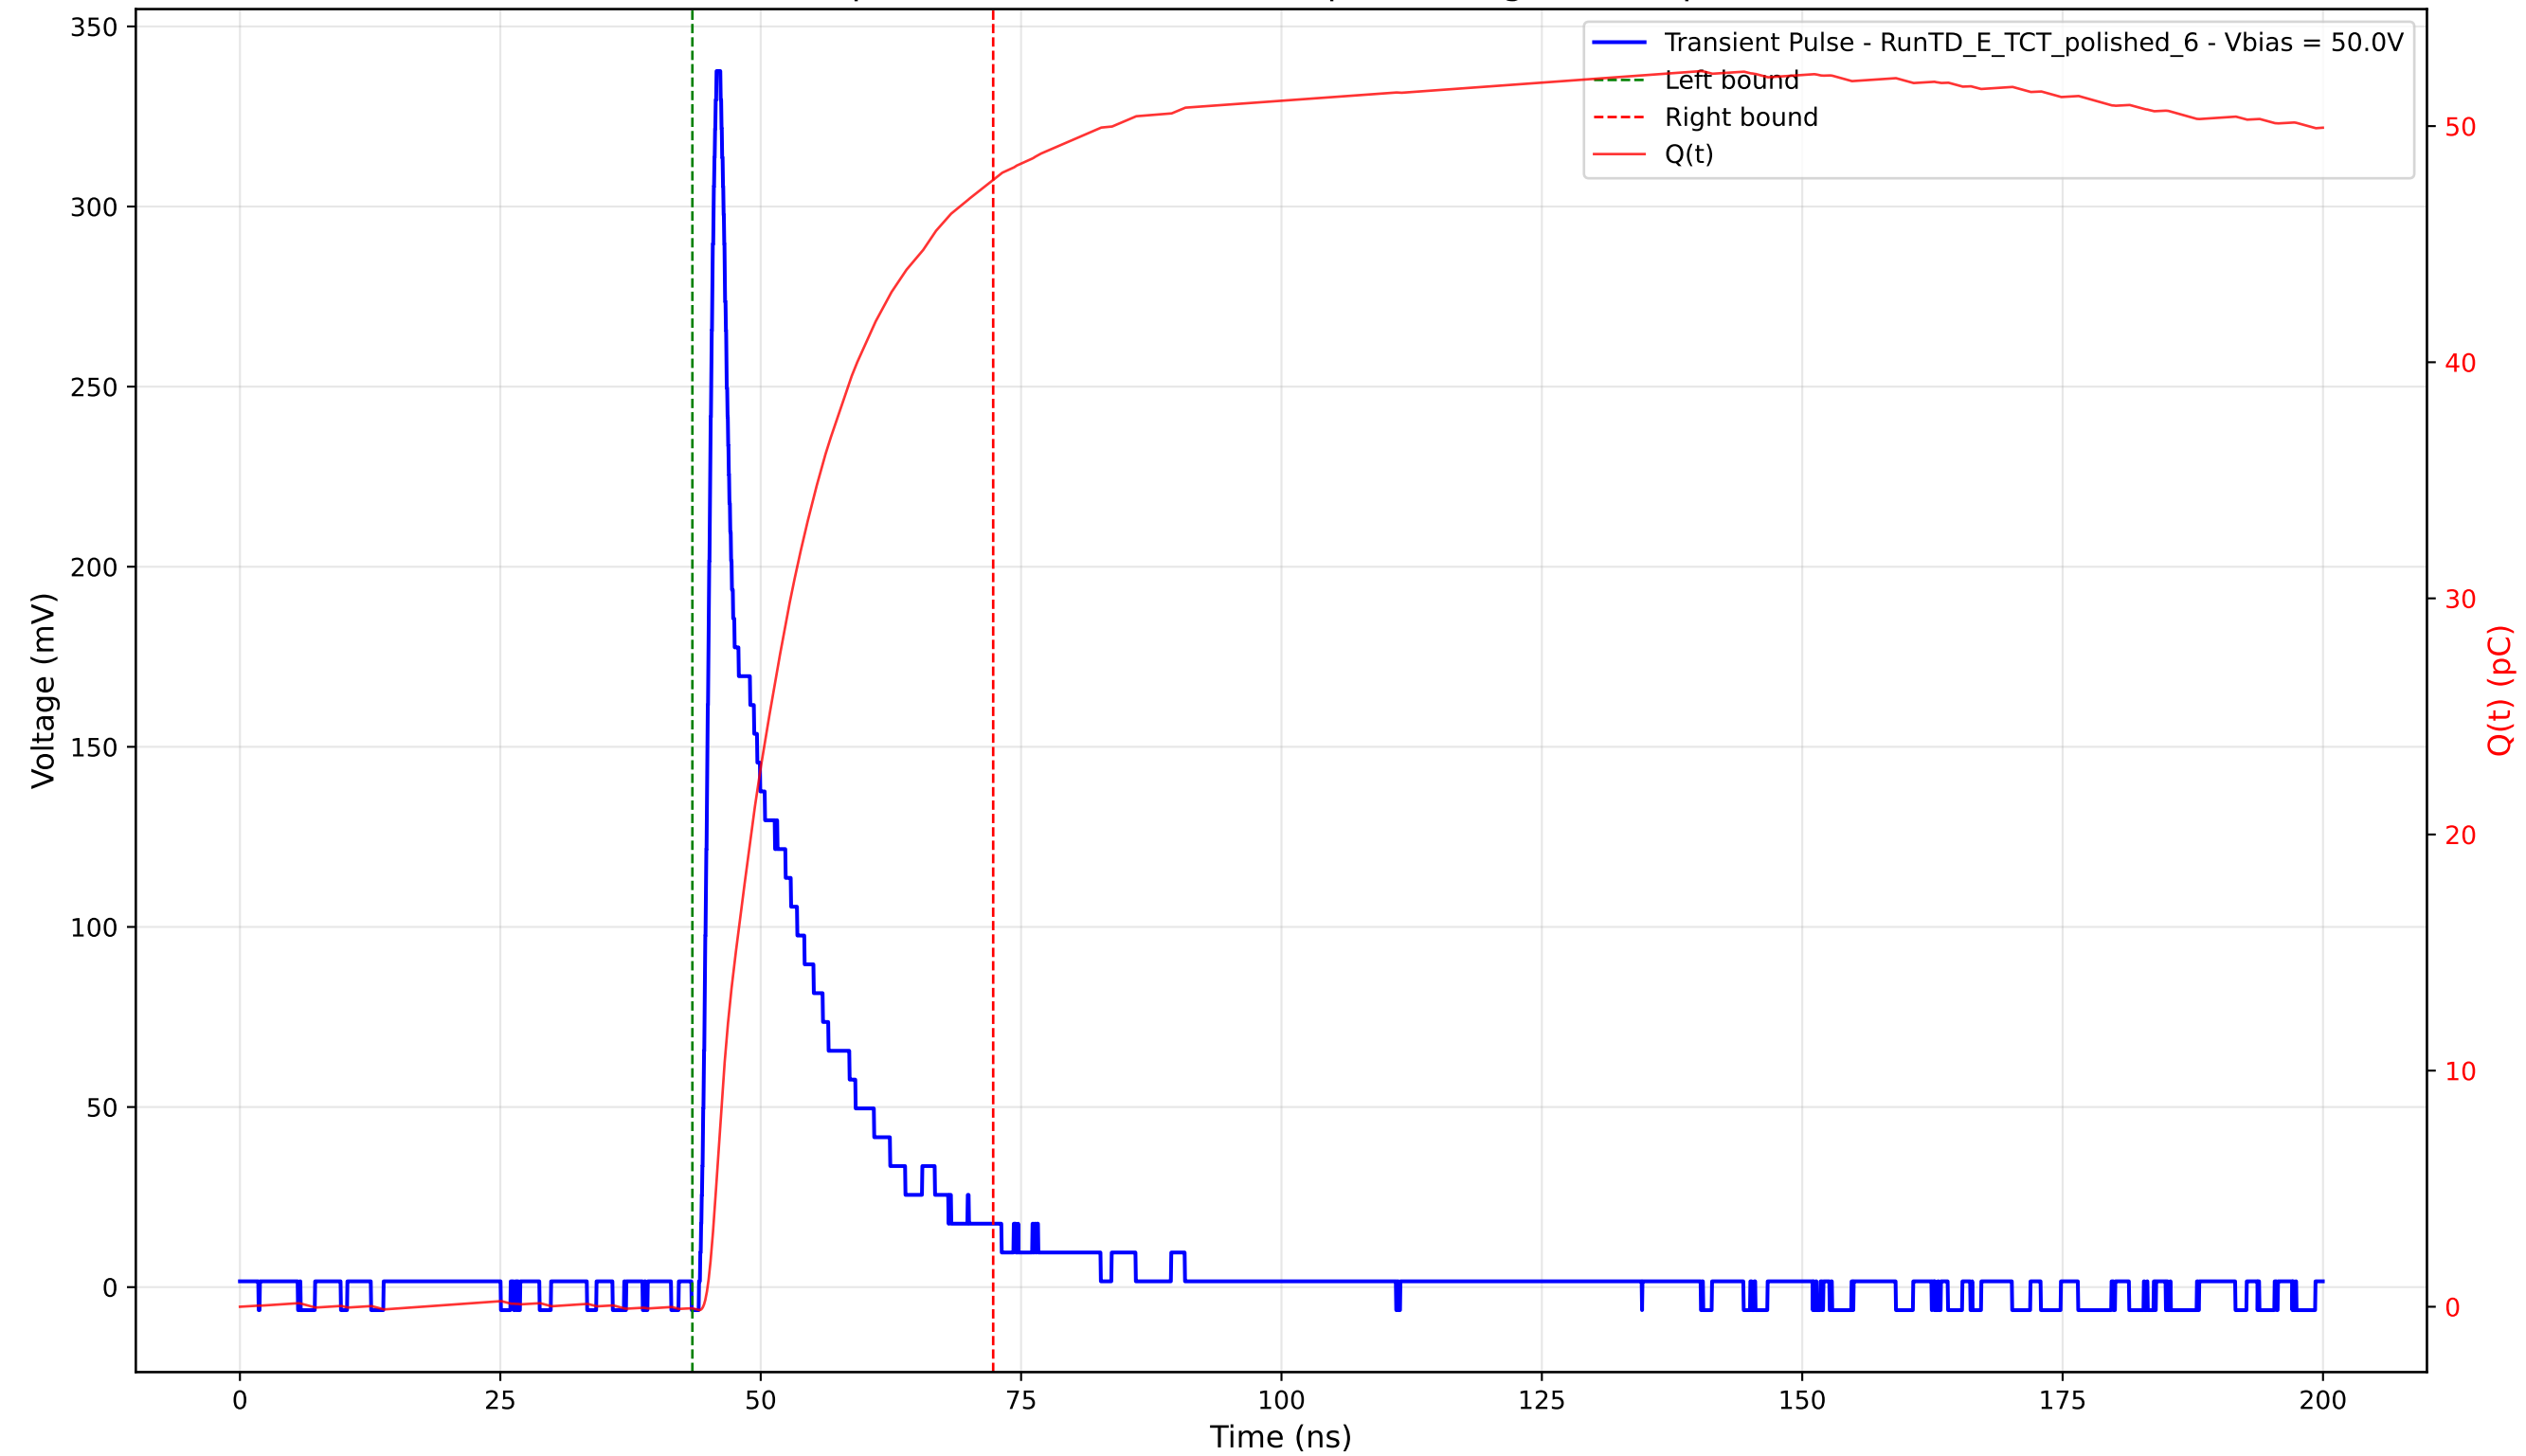


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 47.70 pC - Rise Time: 1.14 ns

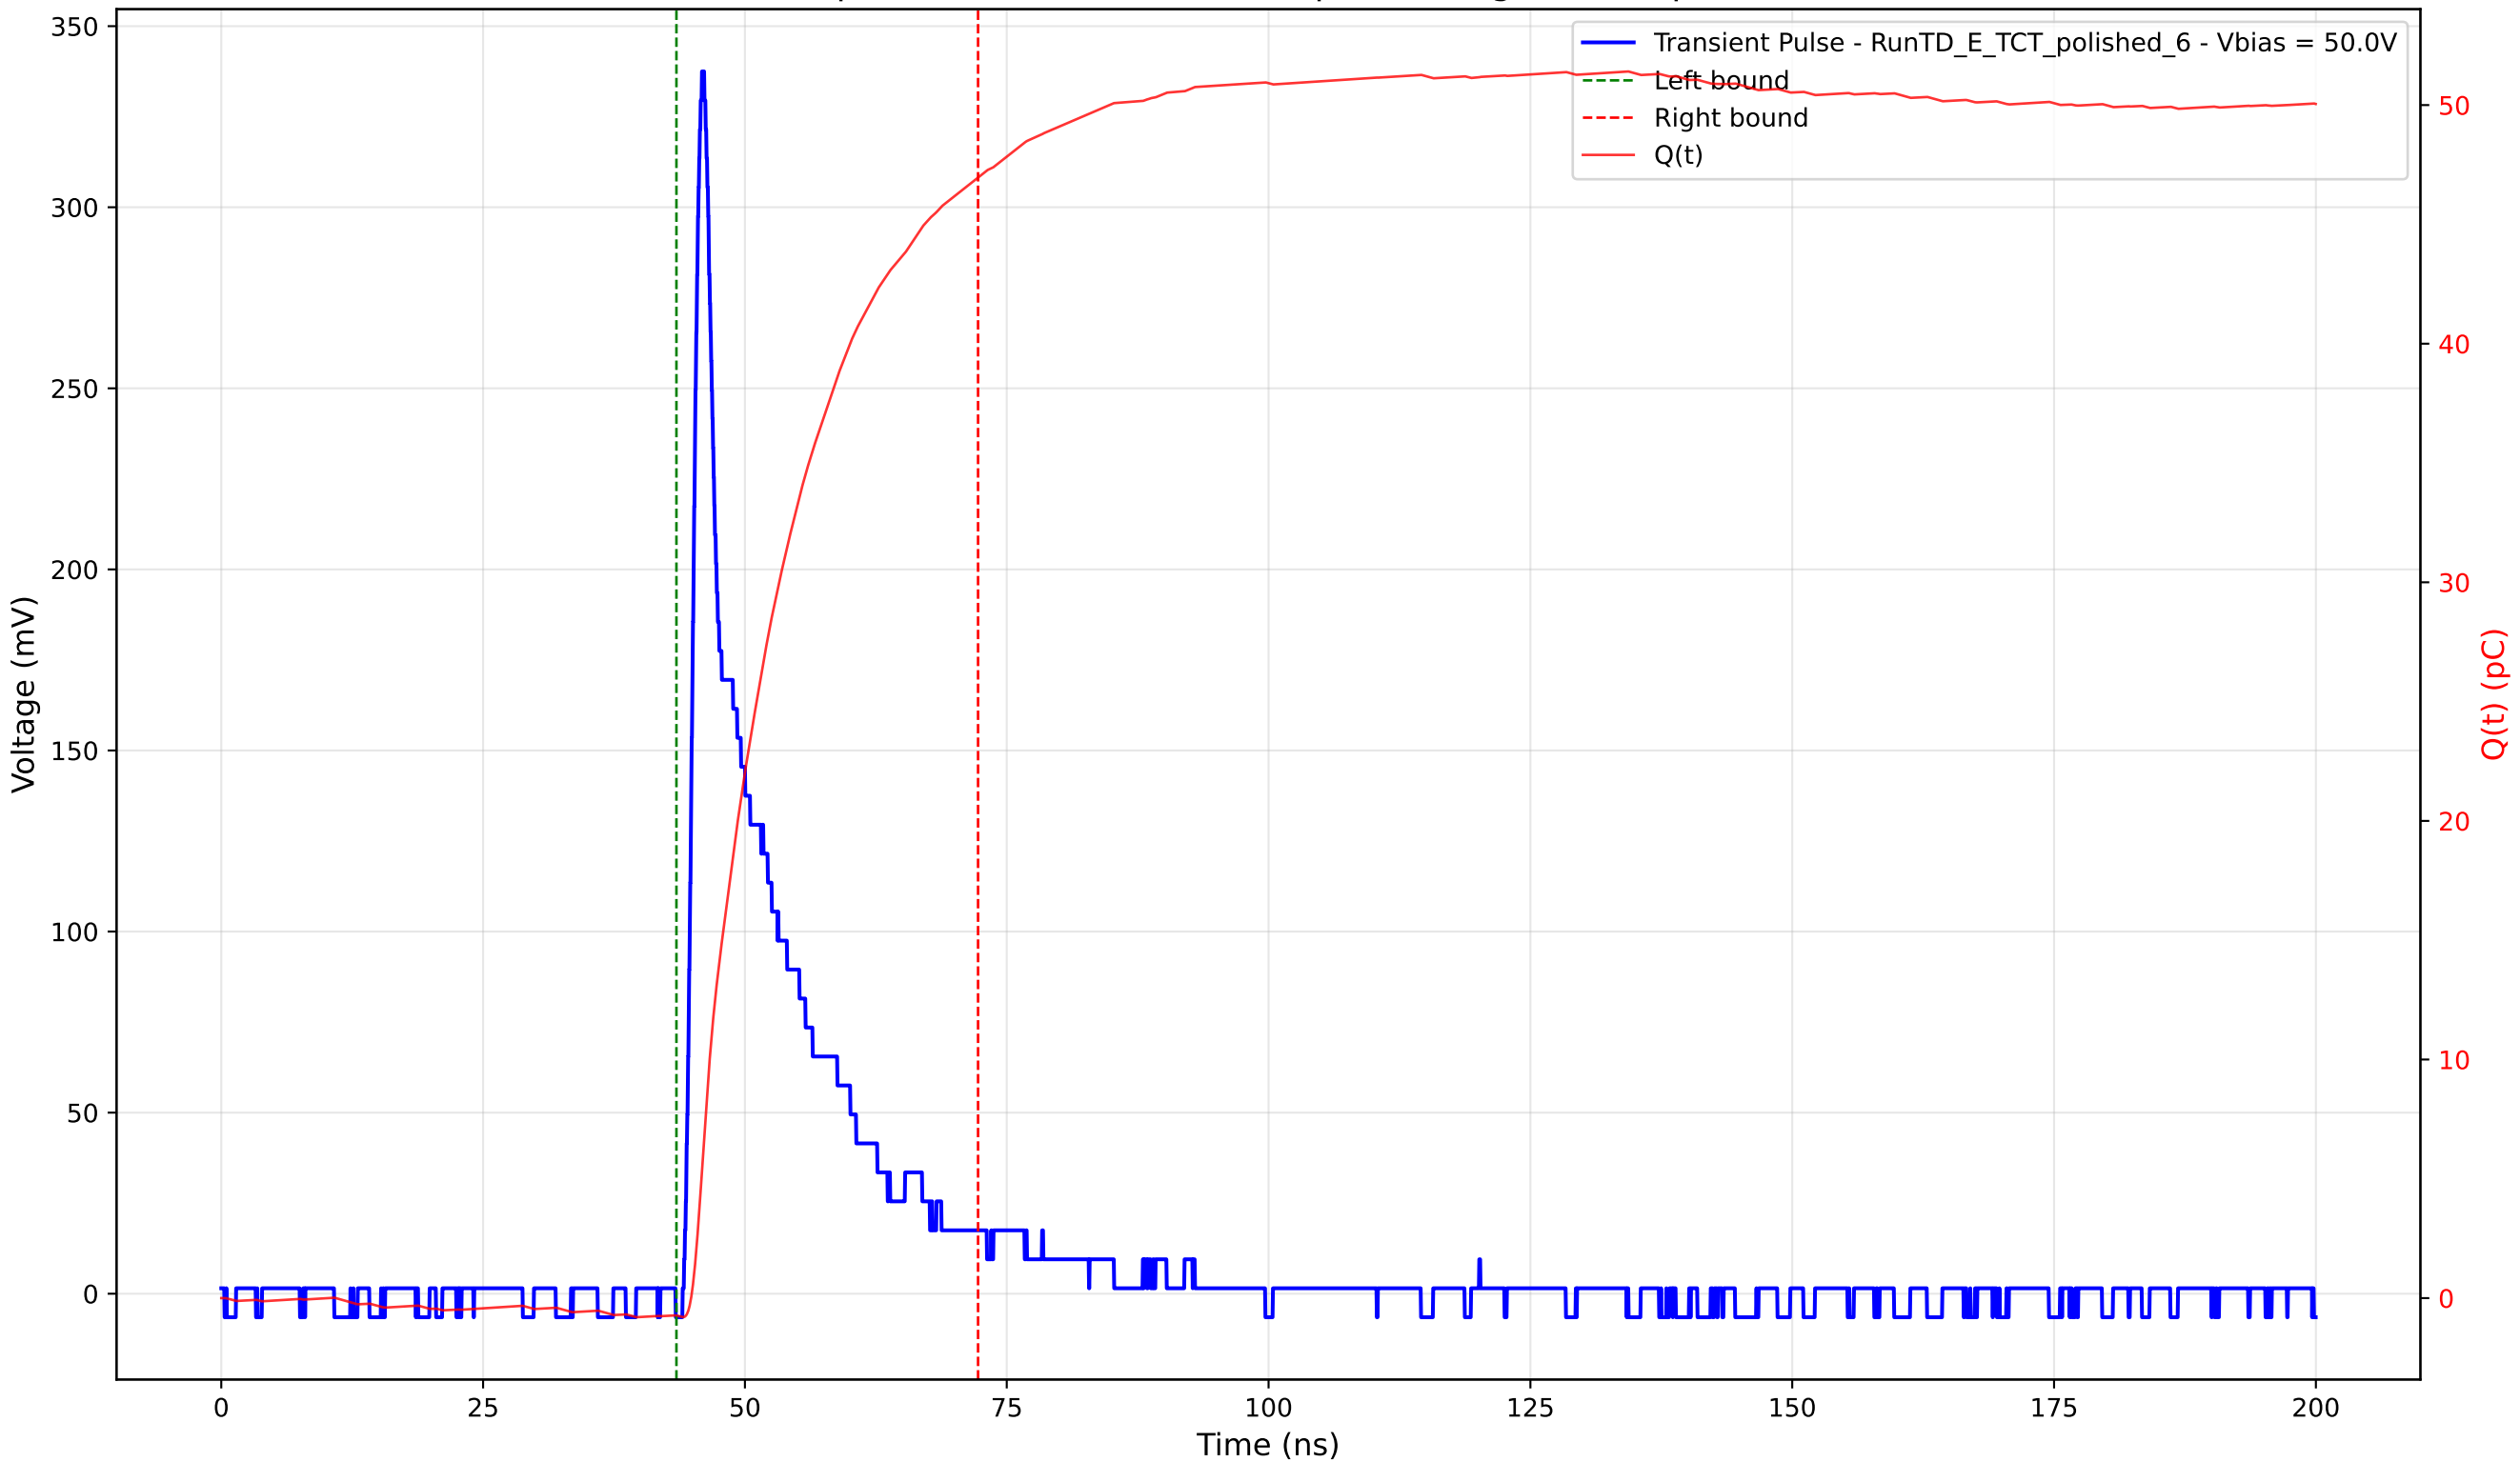


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 47.82 pC - Rise Time: 1.20 ns

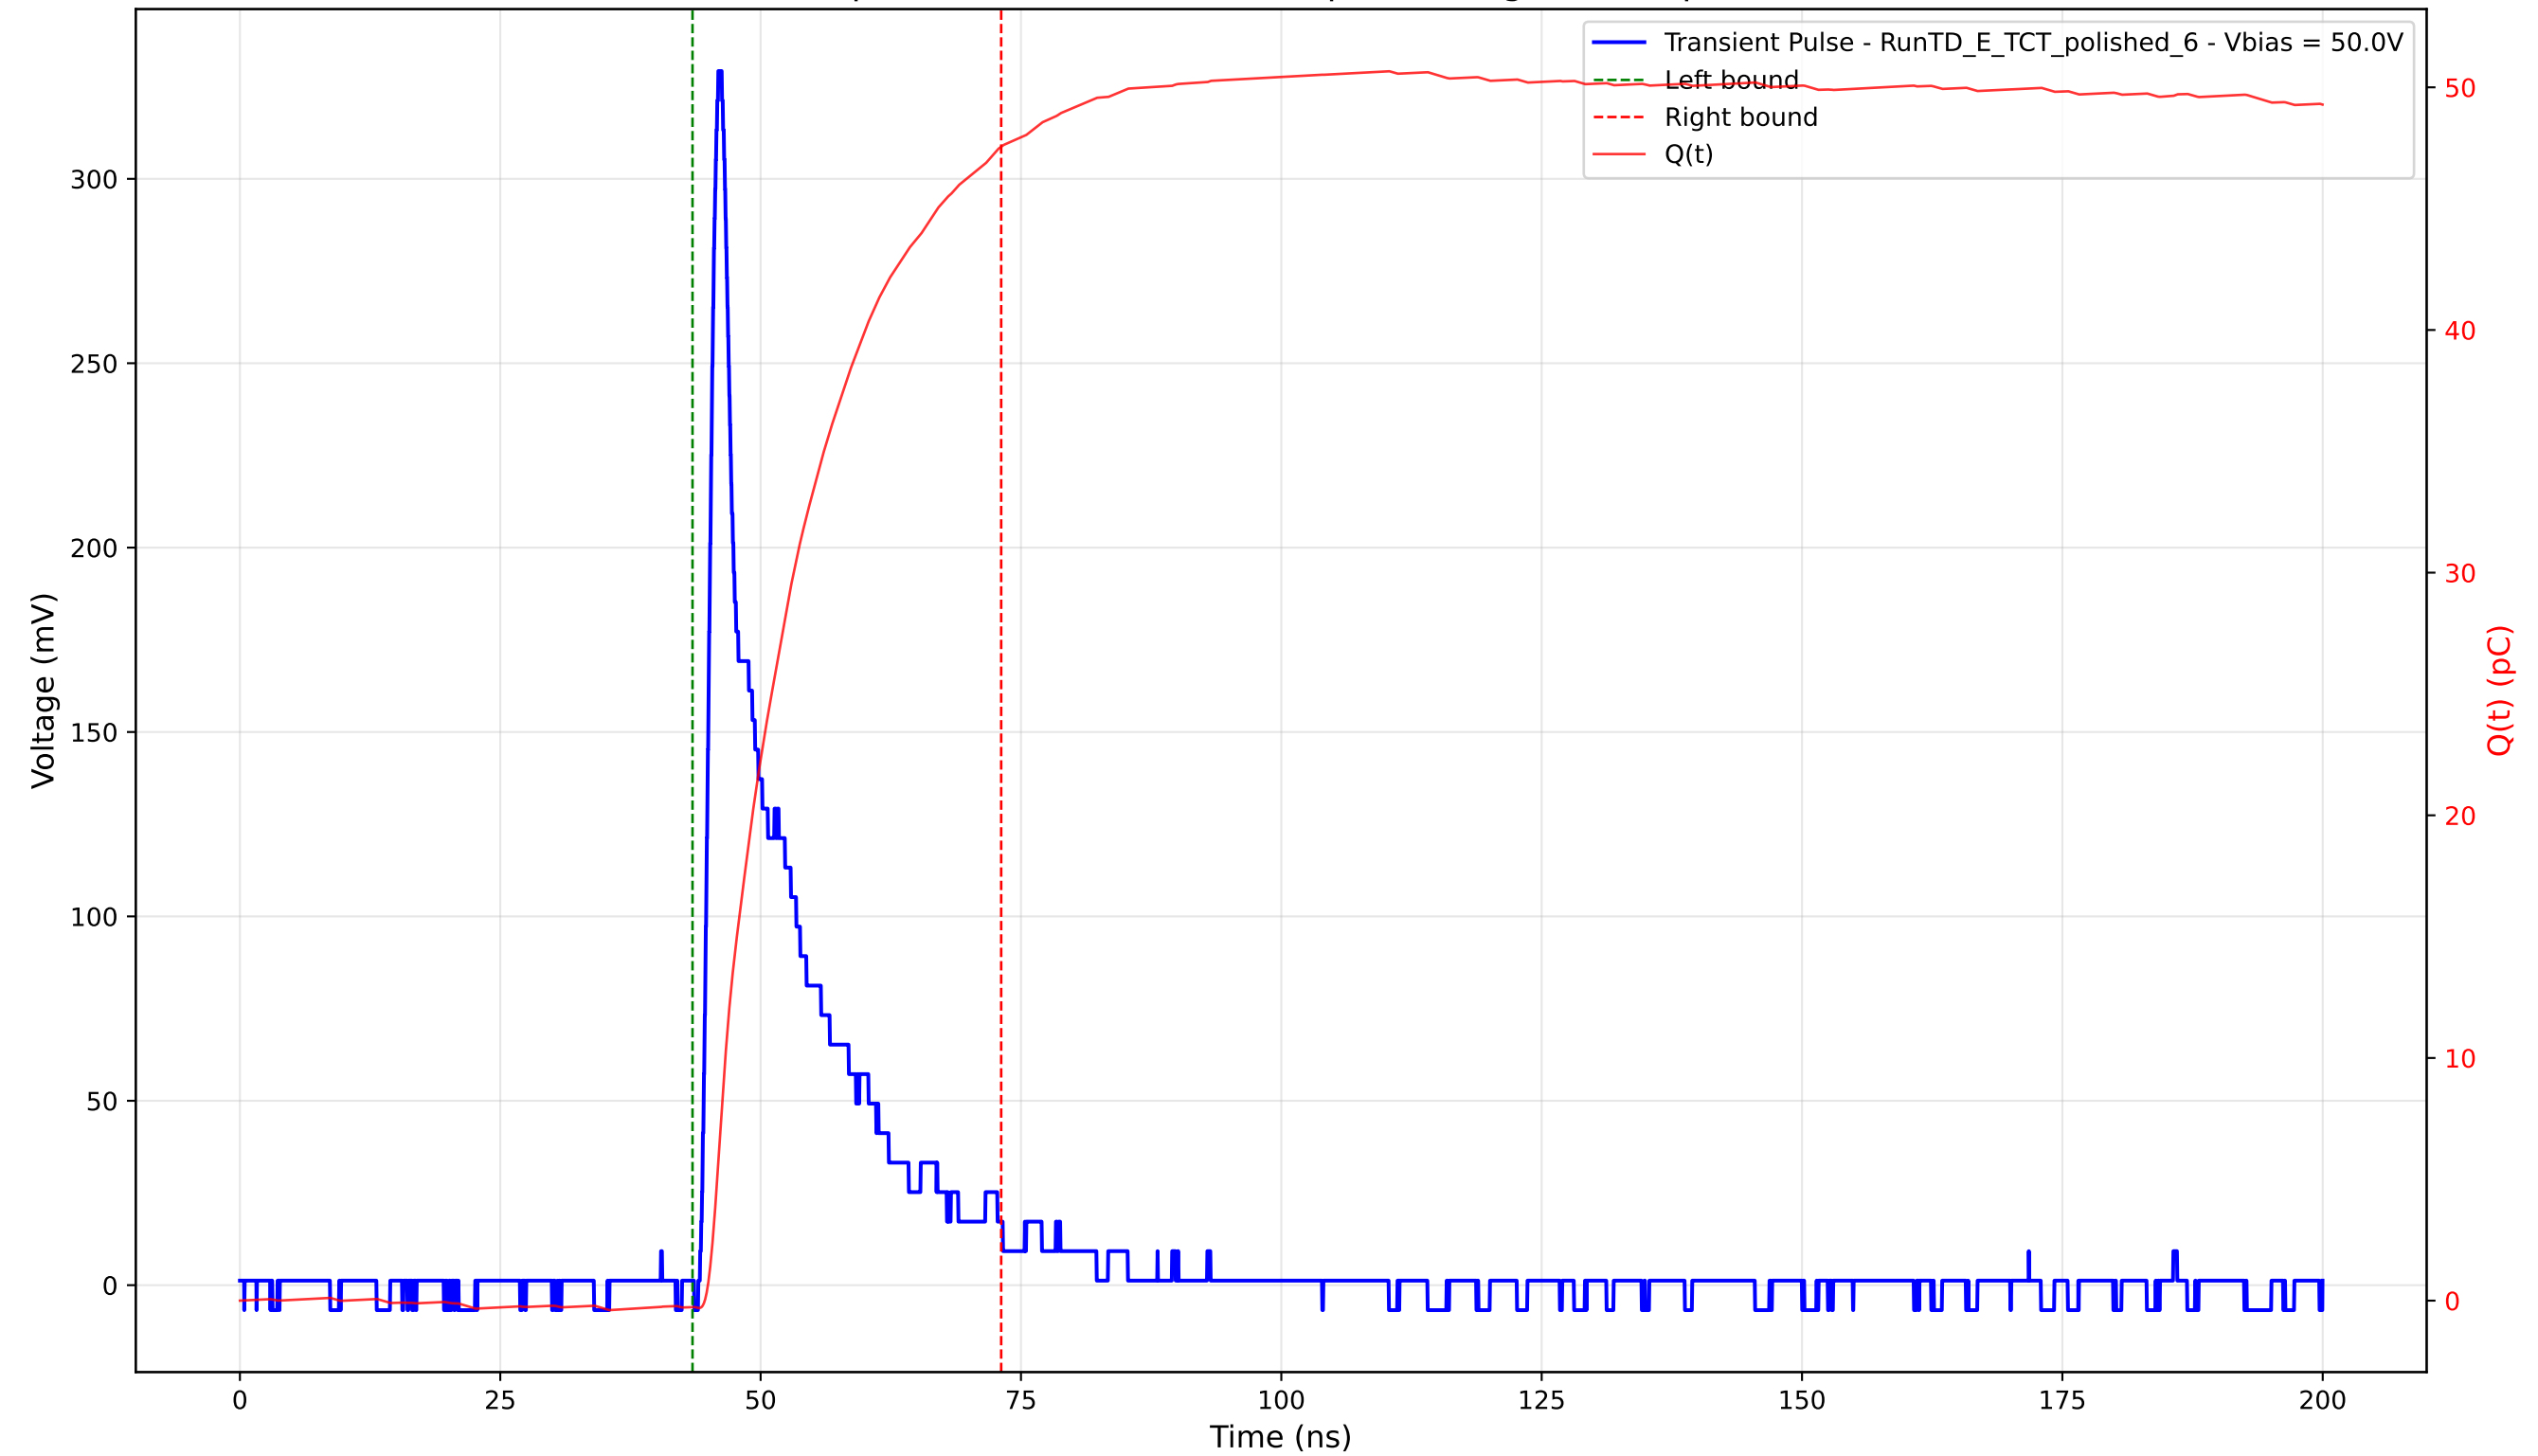


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 46.38 pC - Rise Time: 1.28 ns

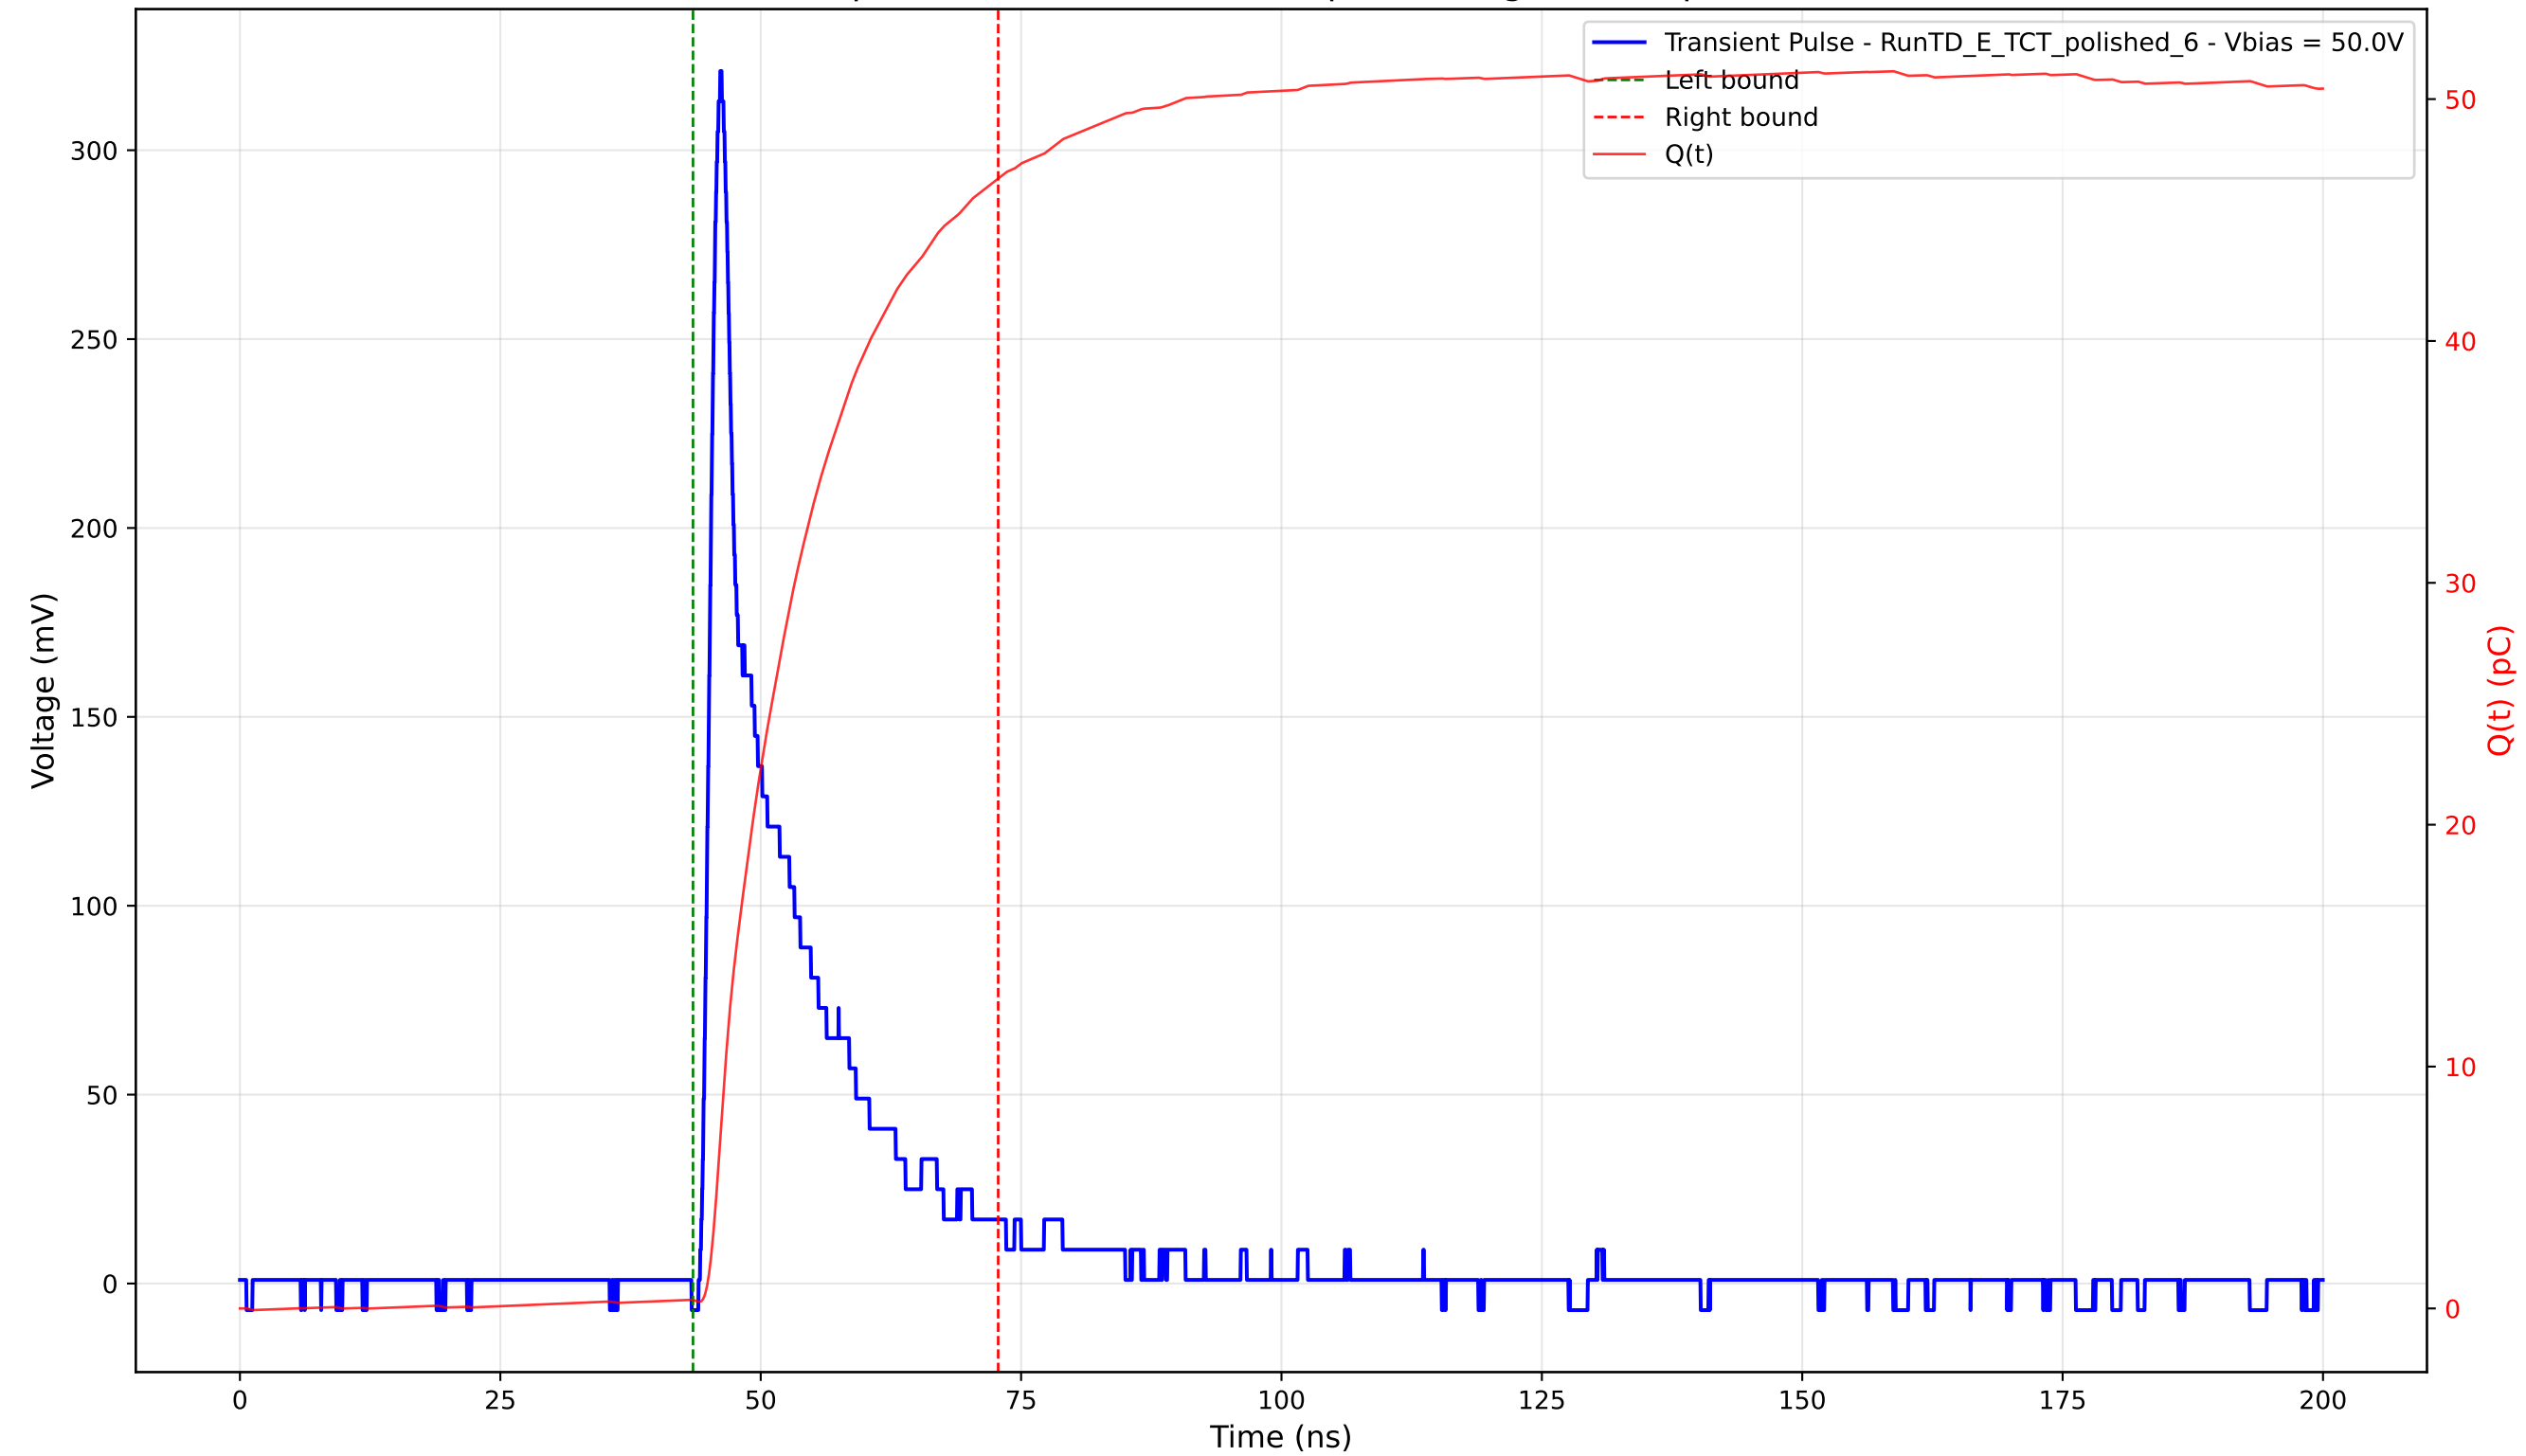


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 45.90 pC - Rise Time: 1.40 ns

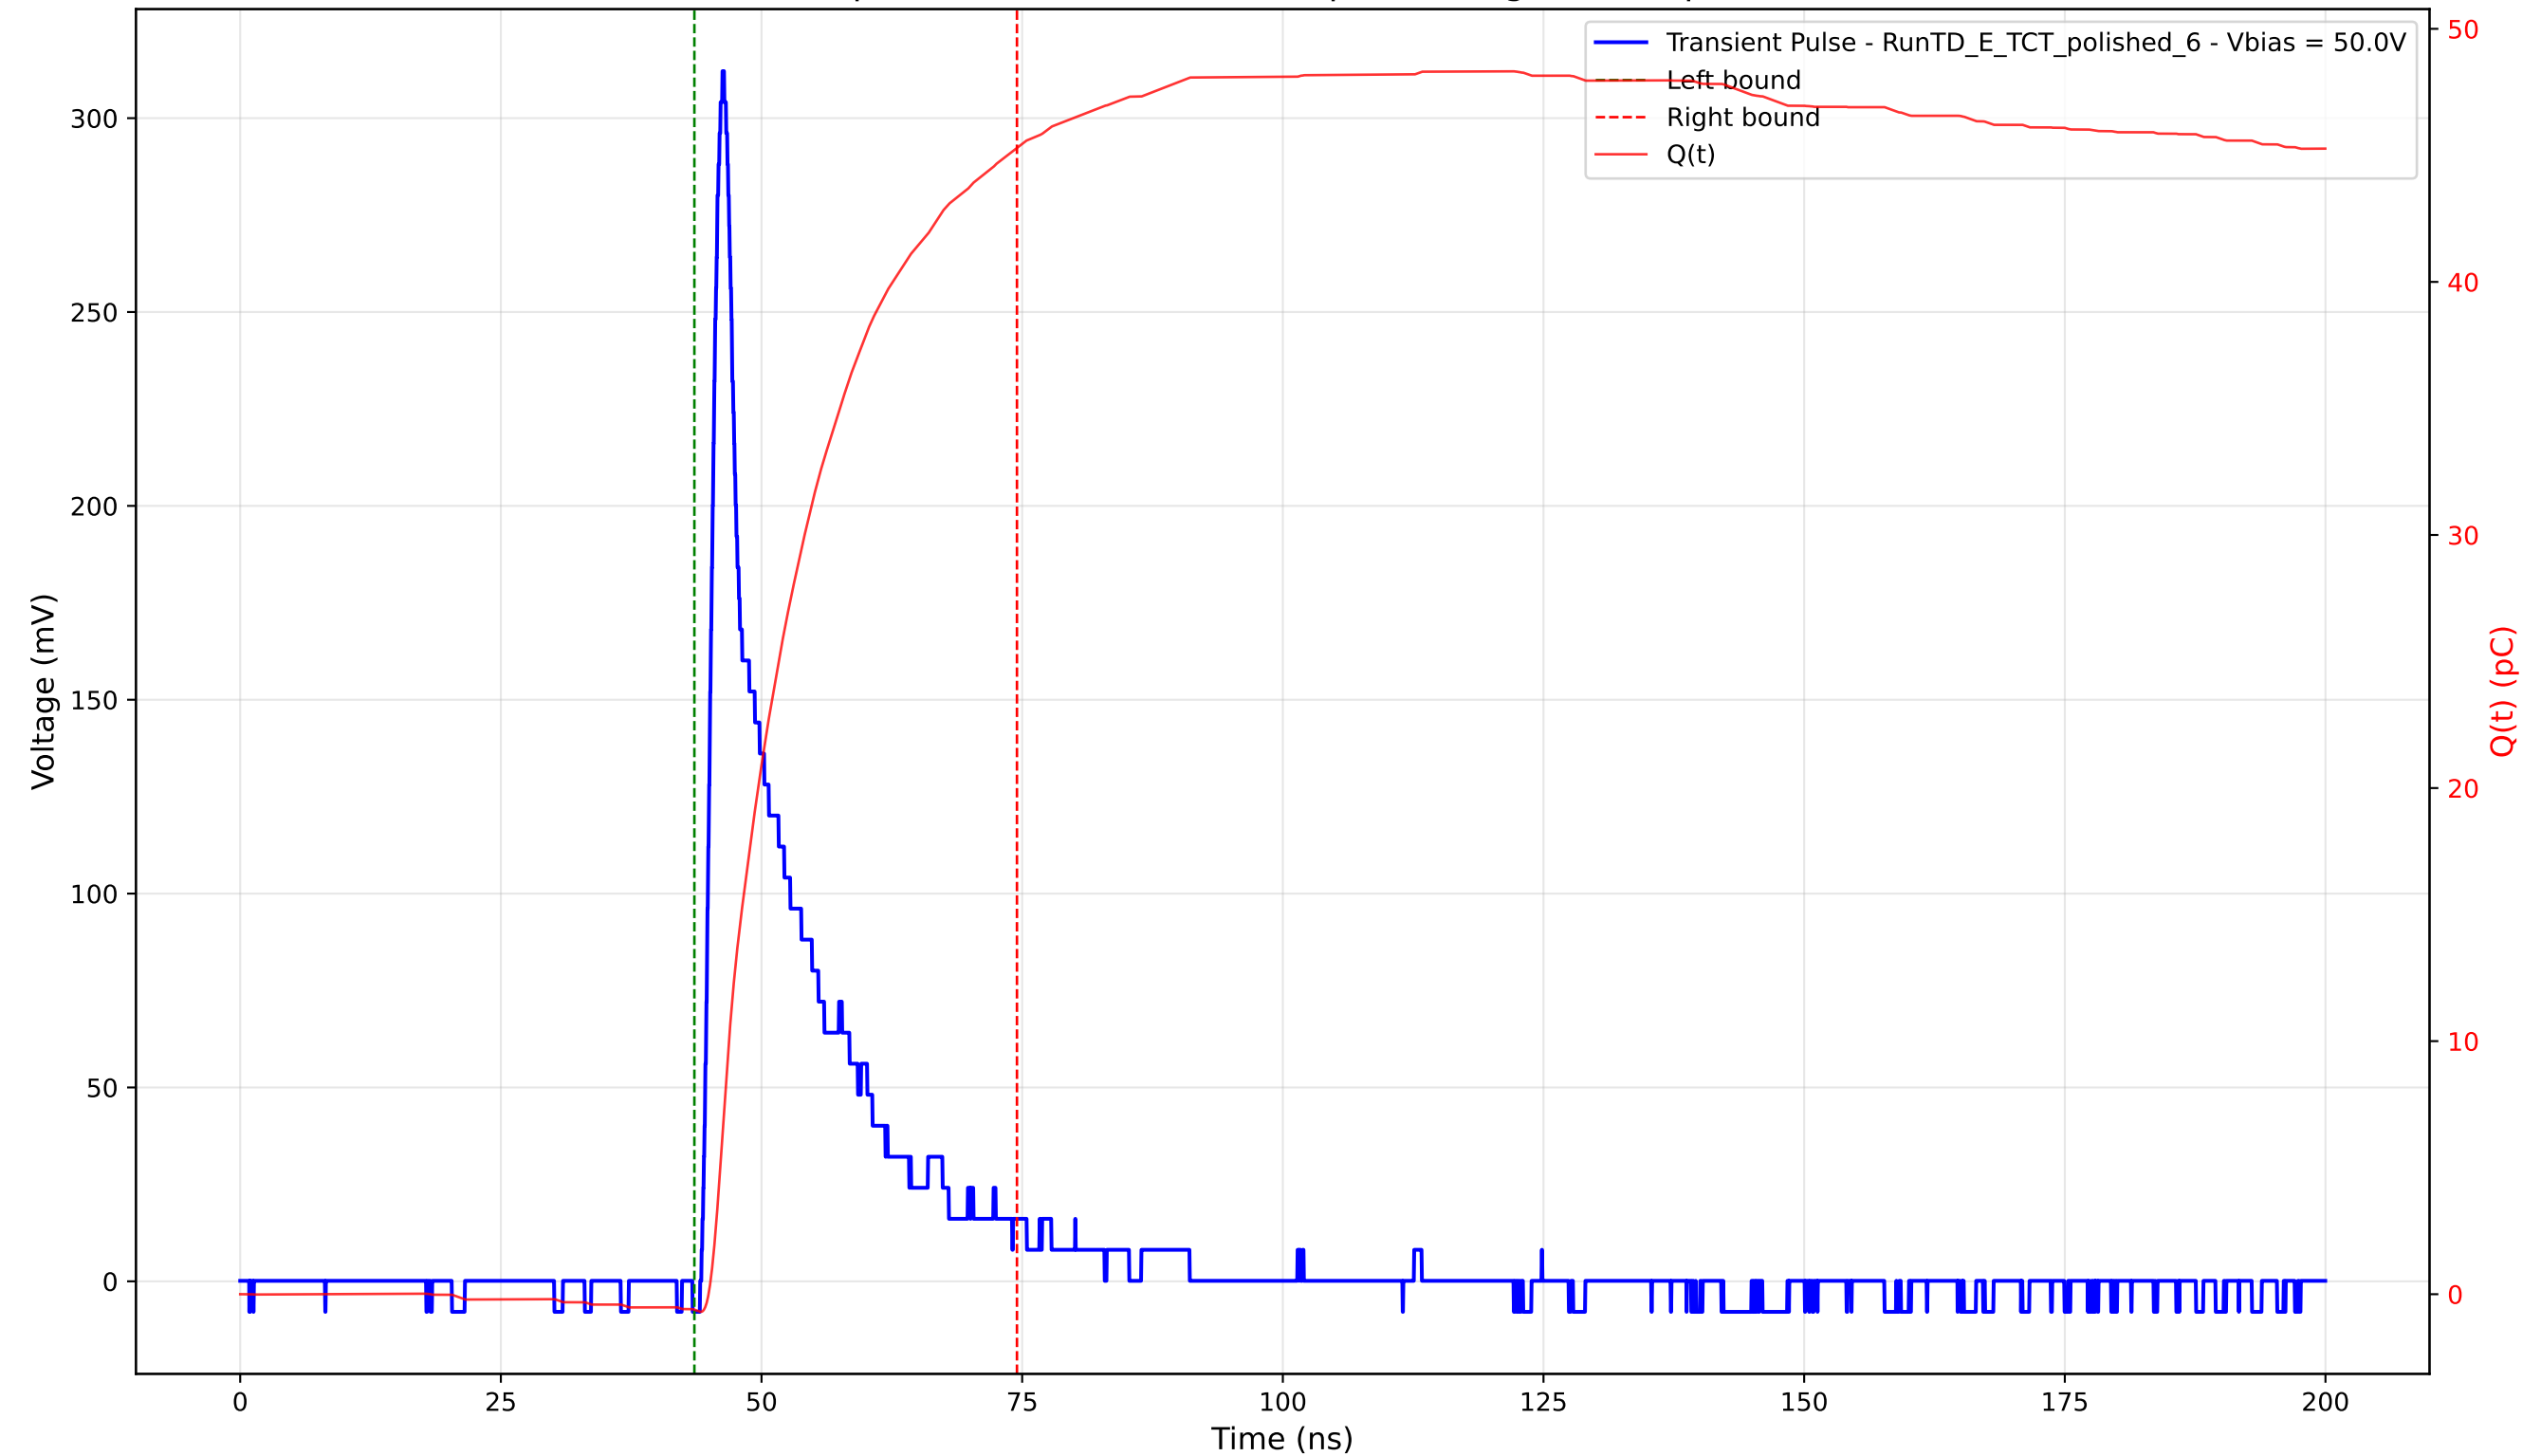


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 48.06 pC - Rise Time: 1.49 ns

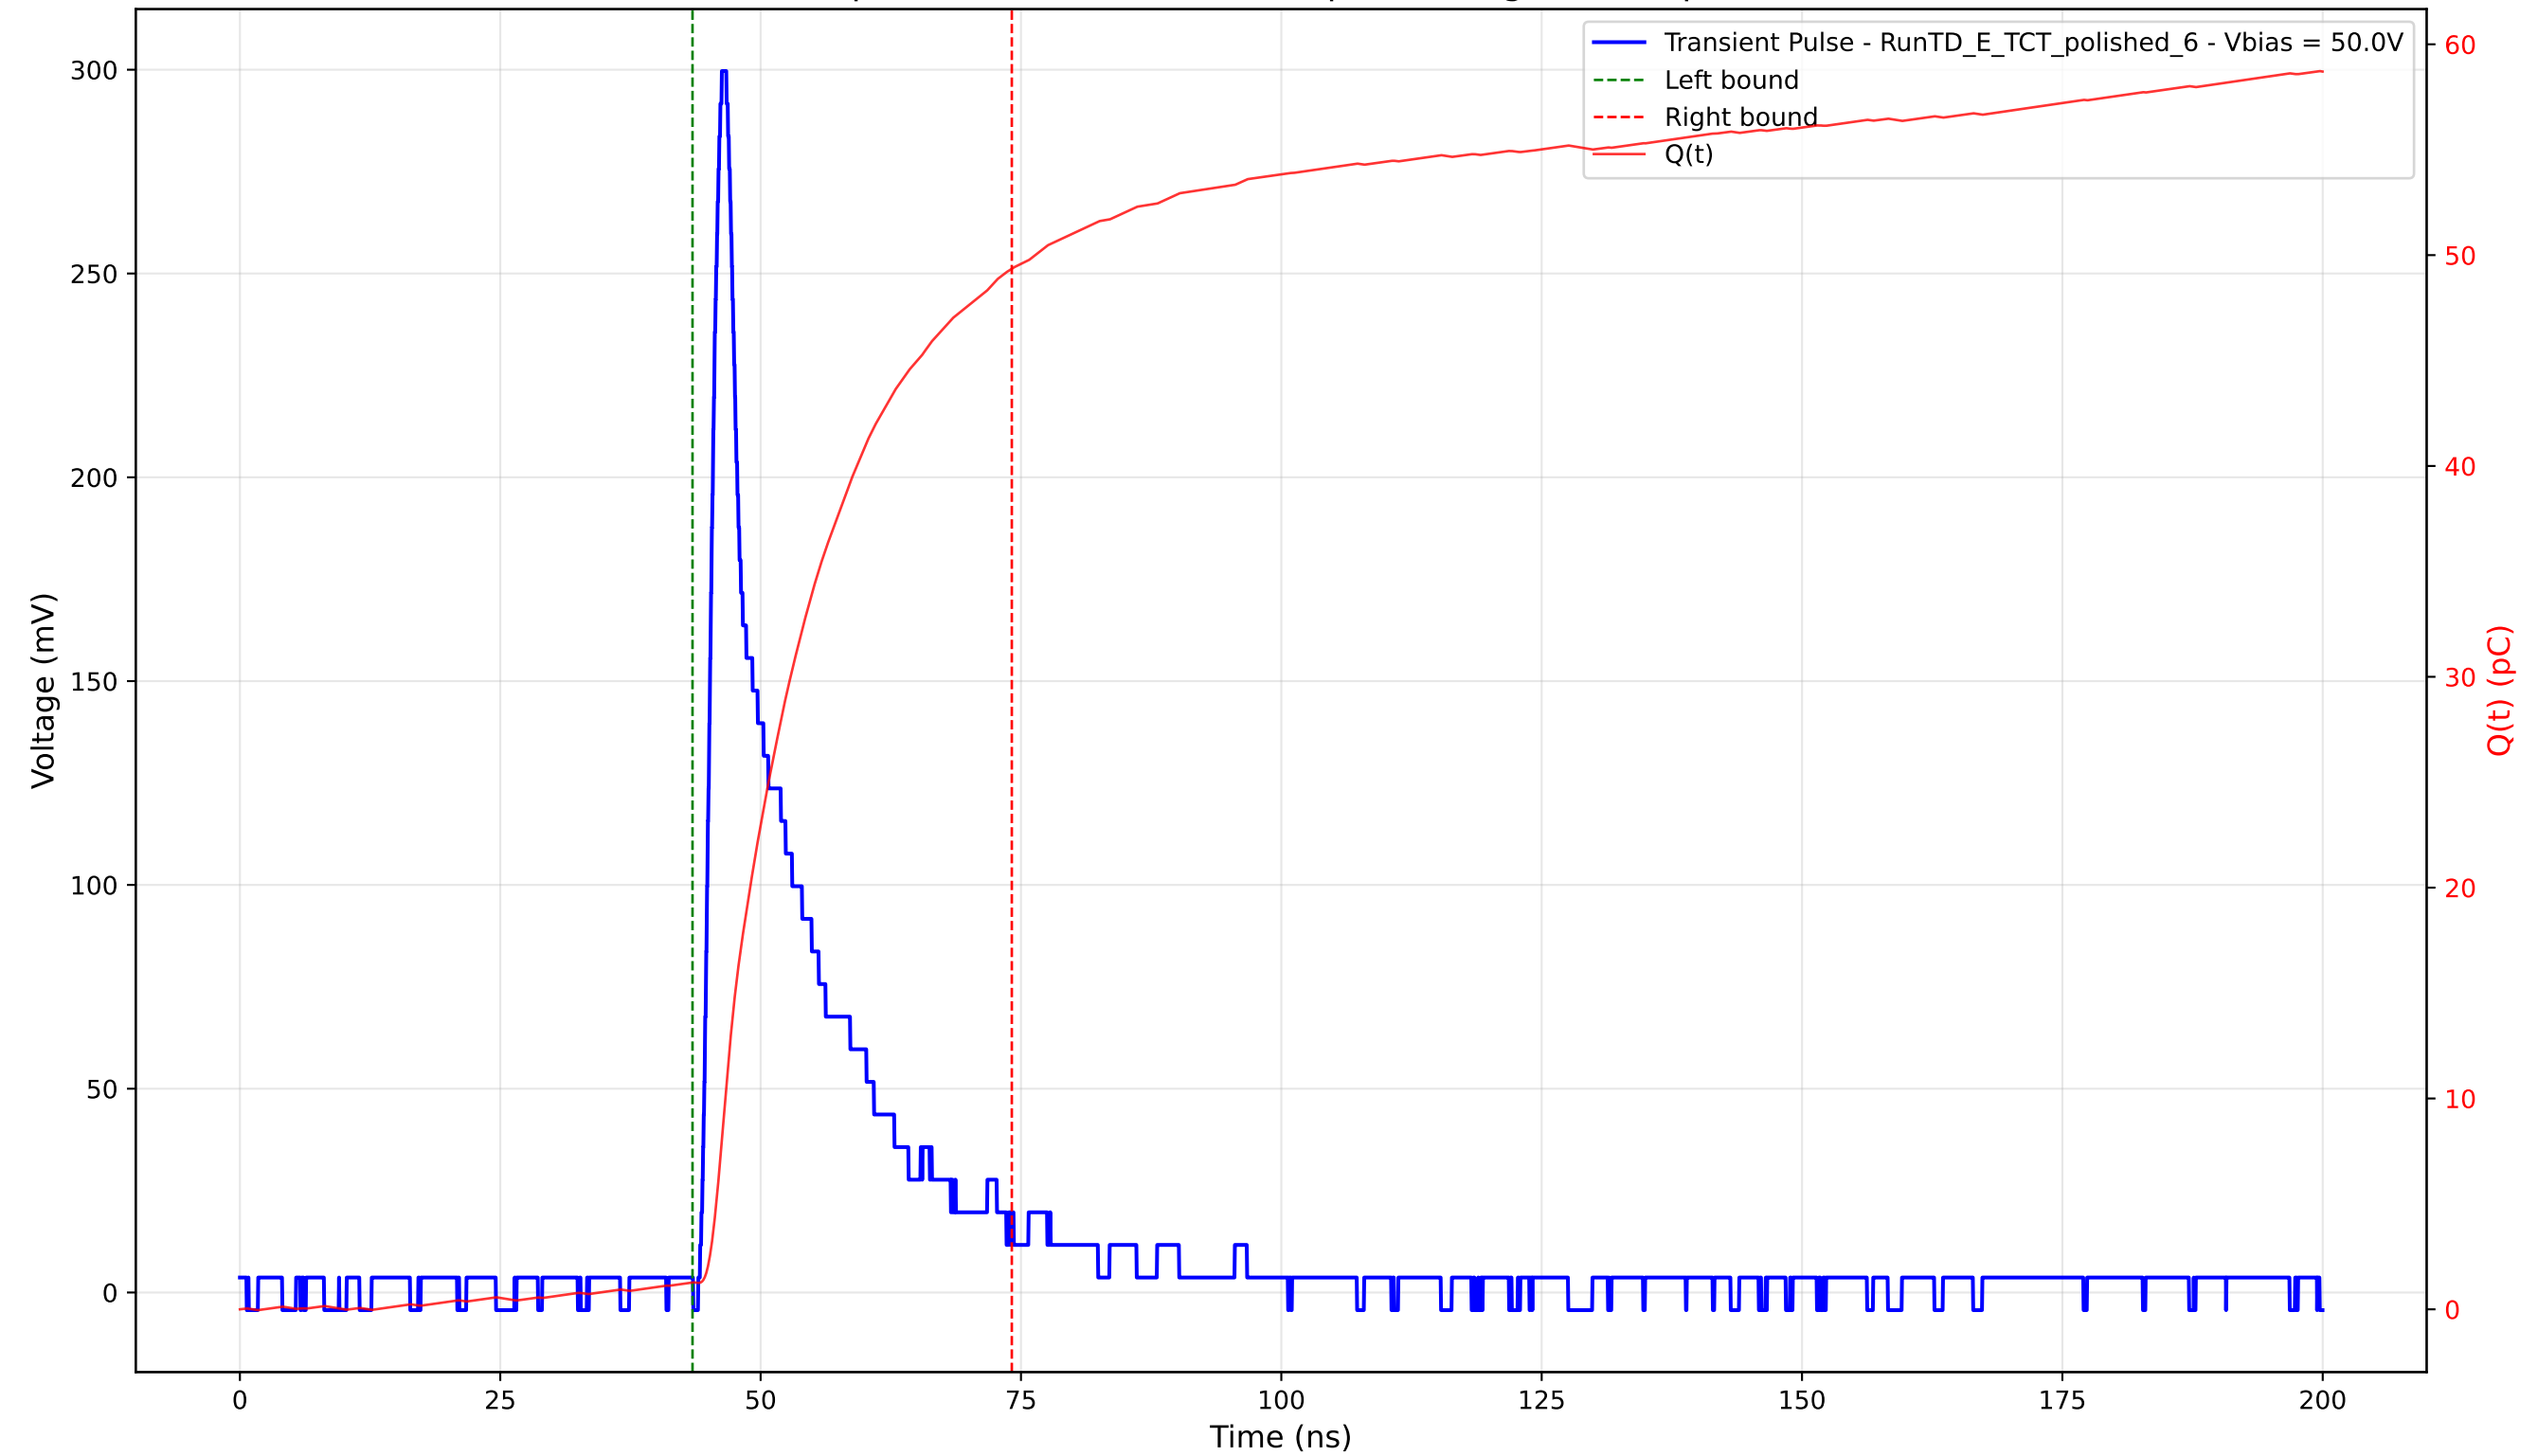


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 45.65 pC - Rise Time: 1.57 ns

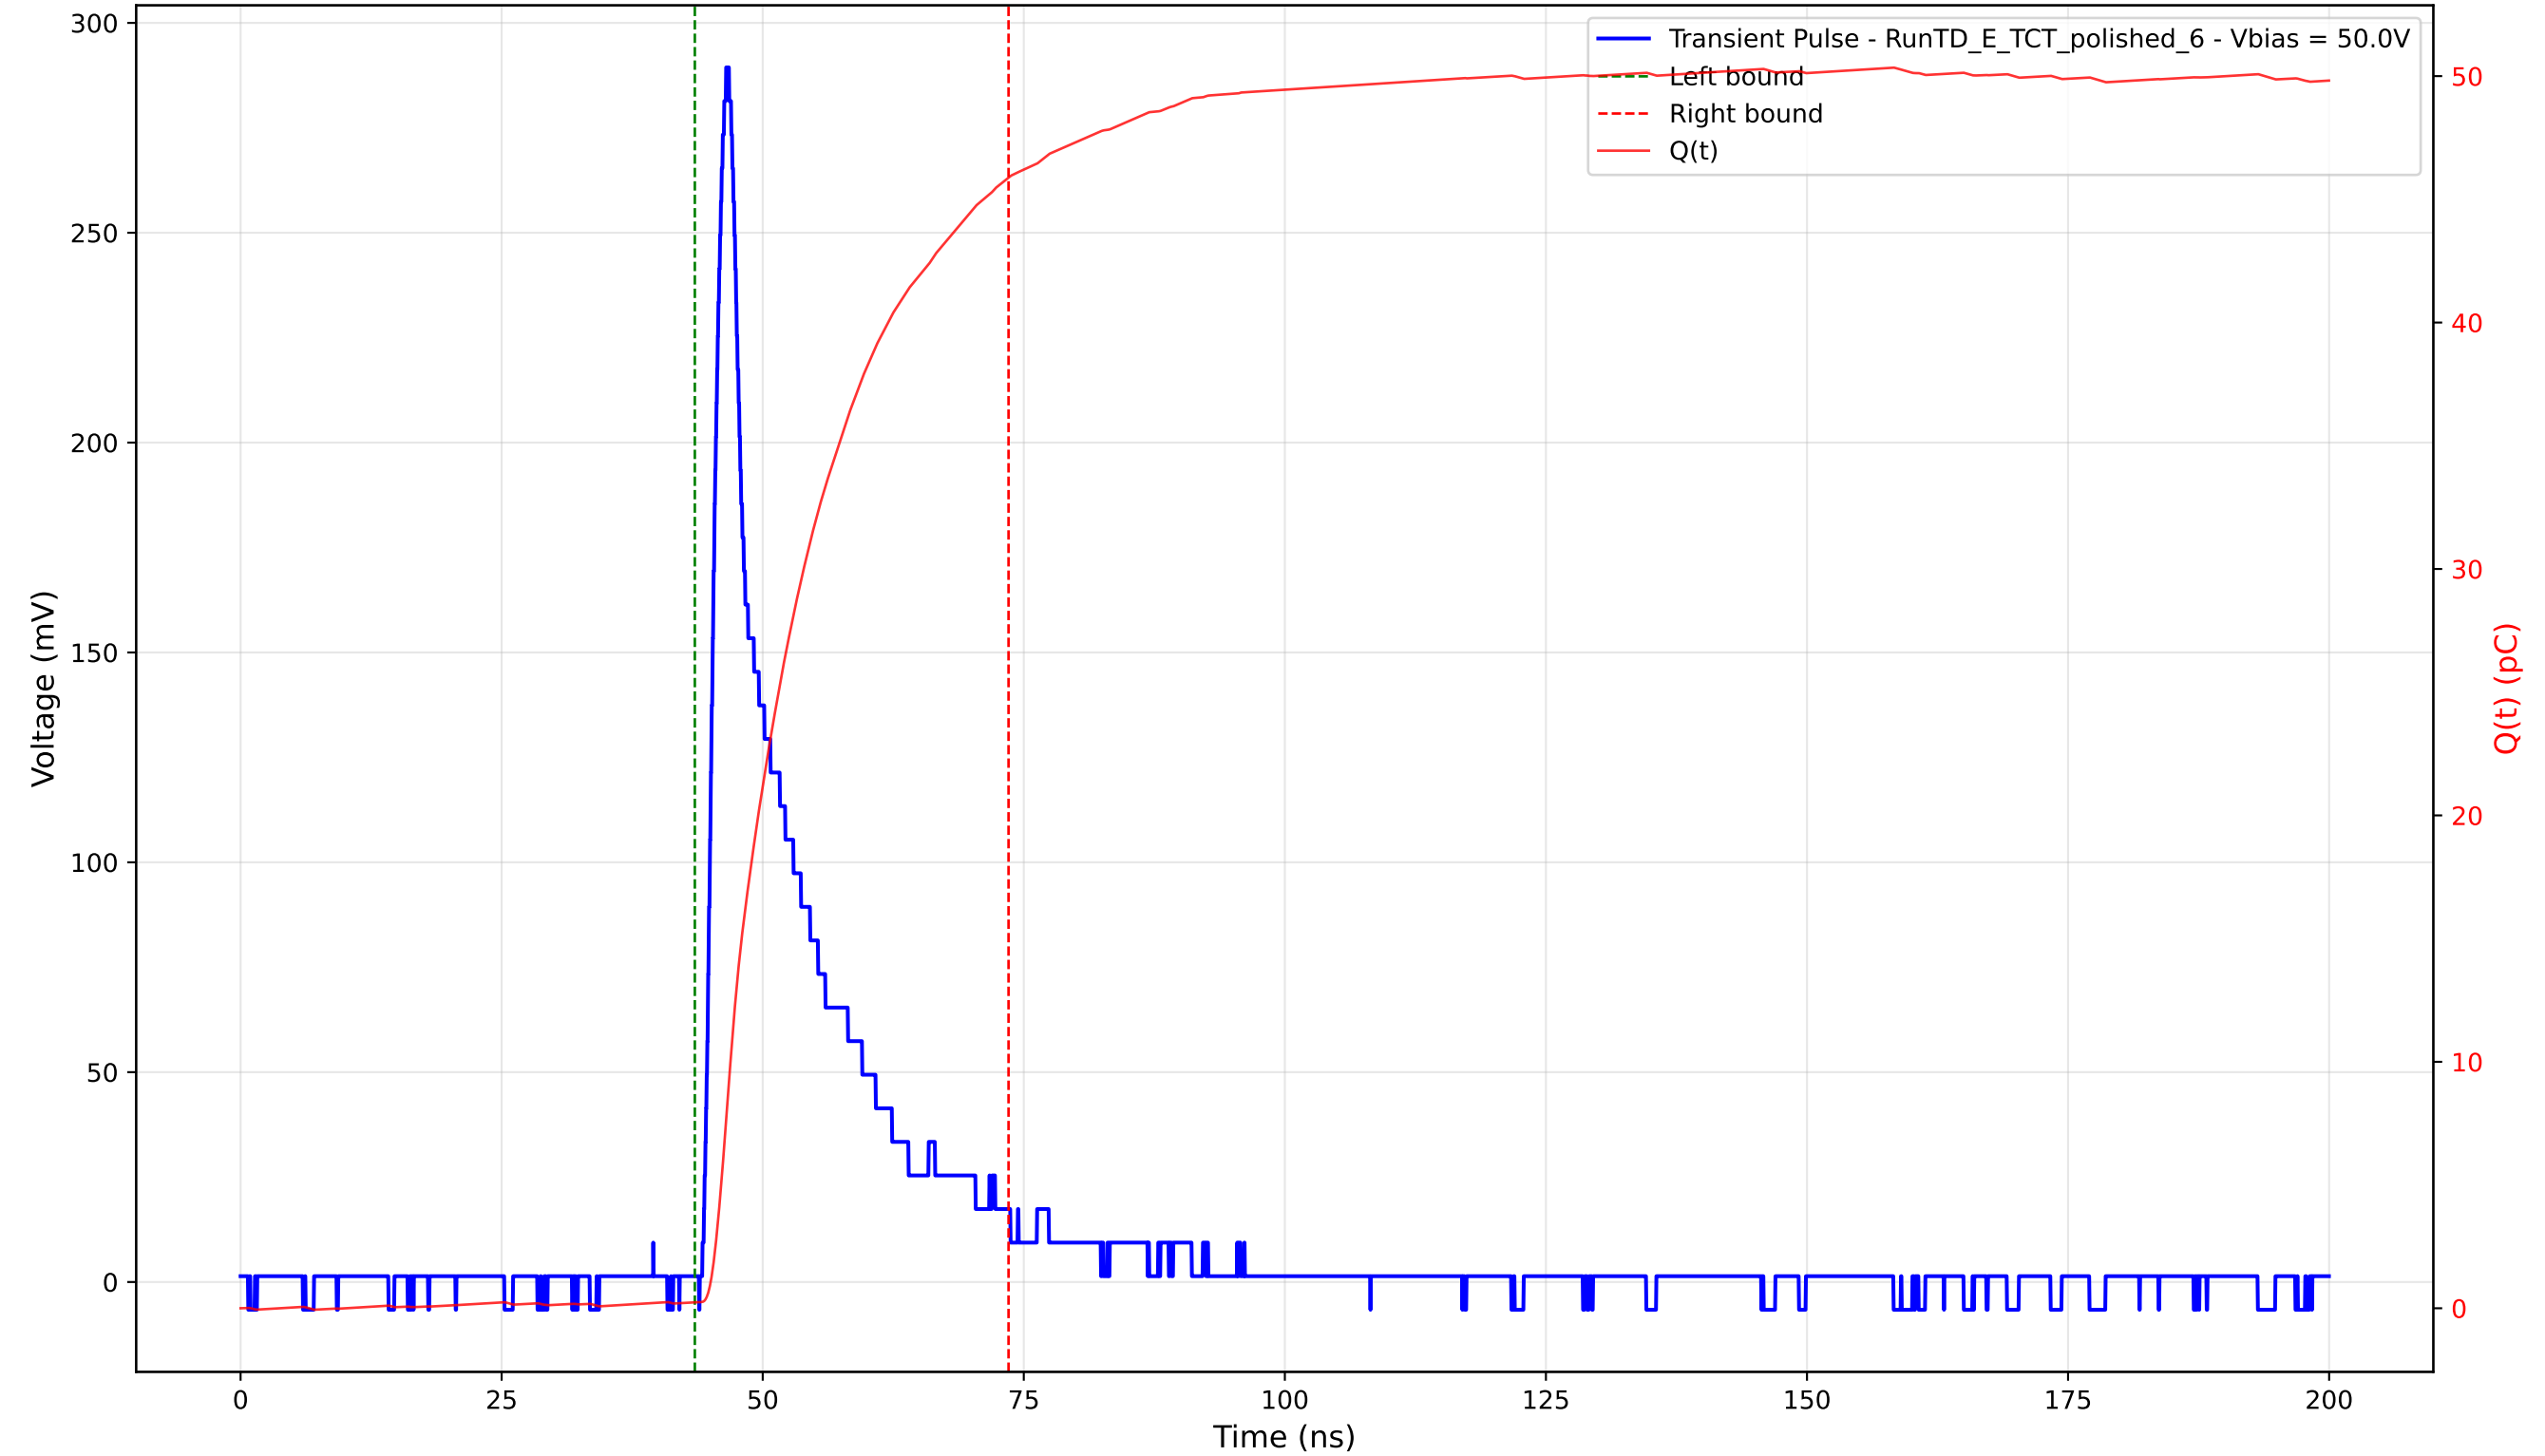


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 44.58 pC - Rise Time: 1.69 ns

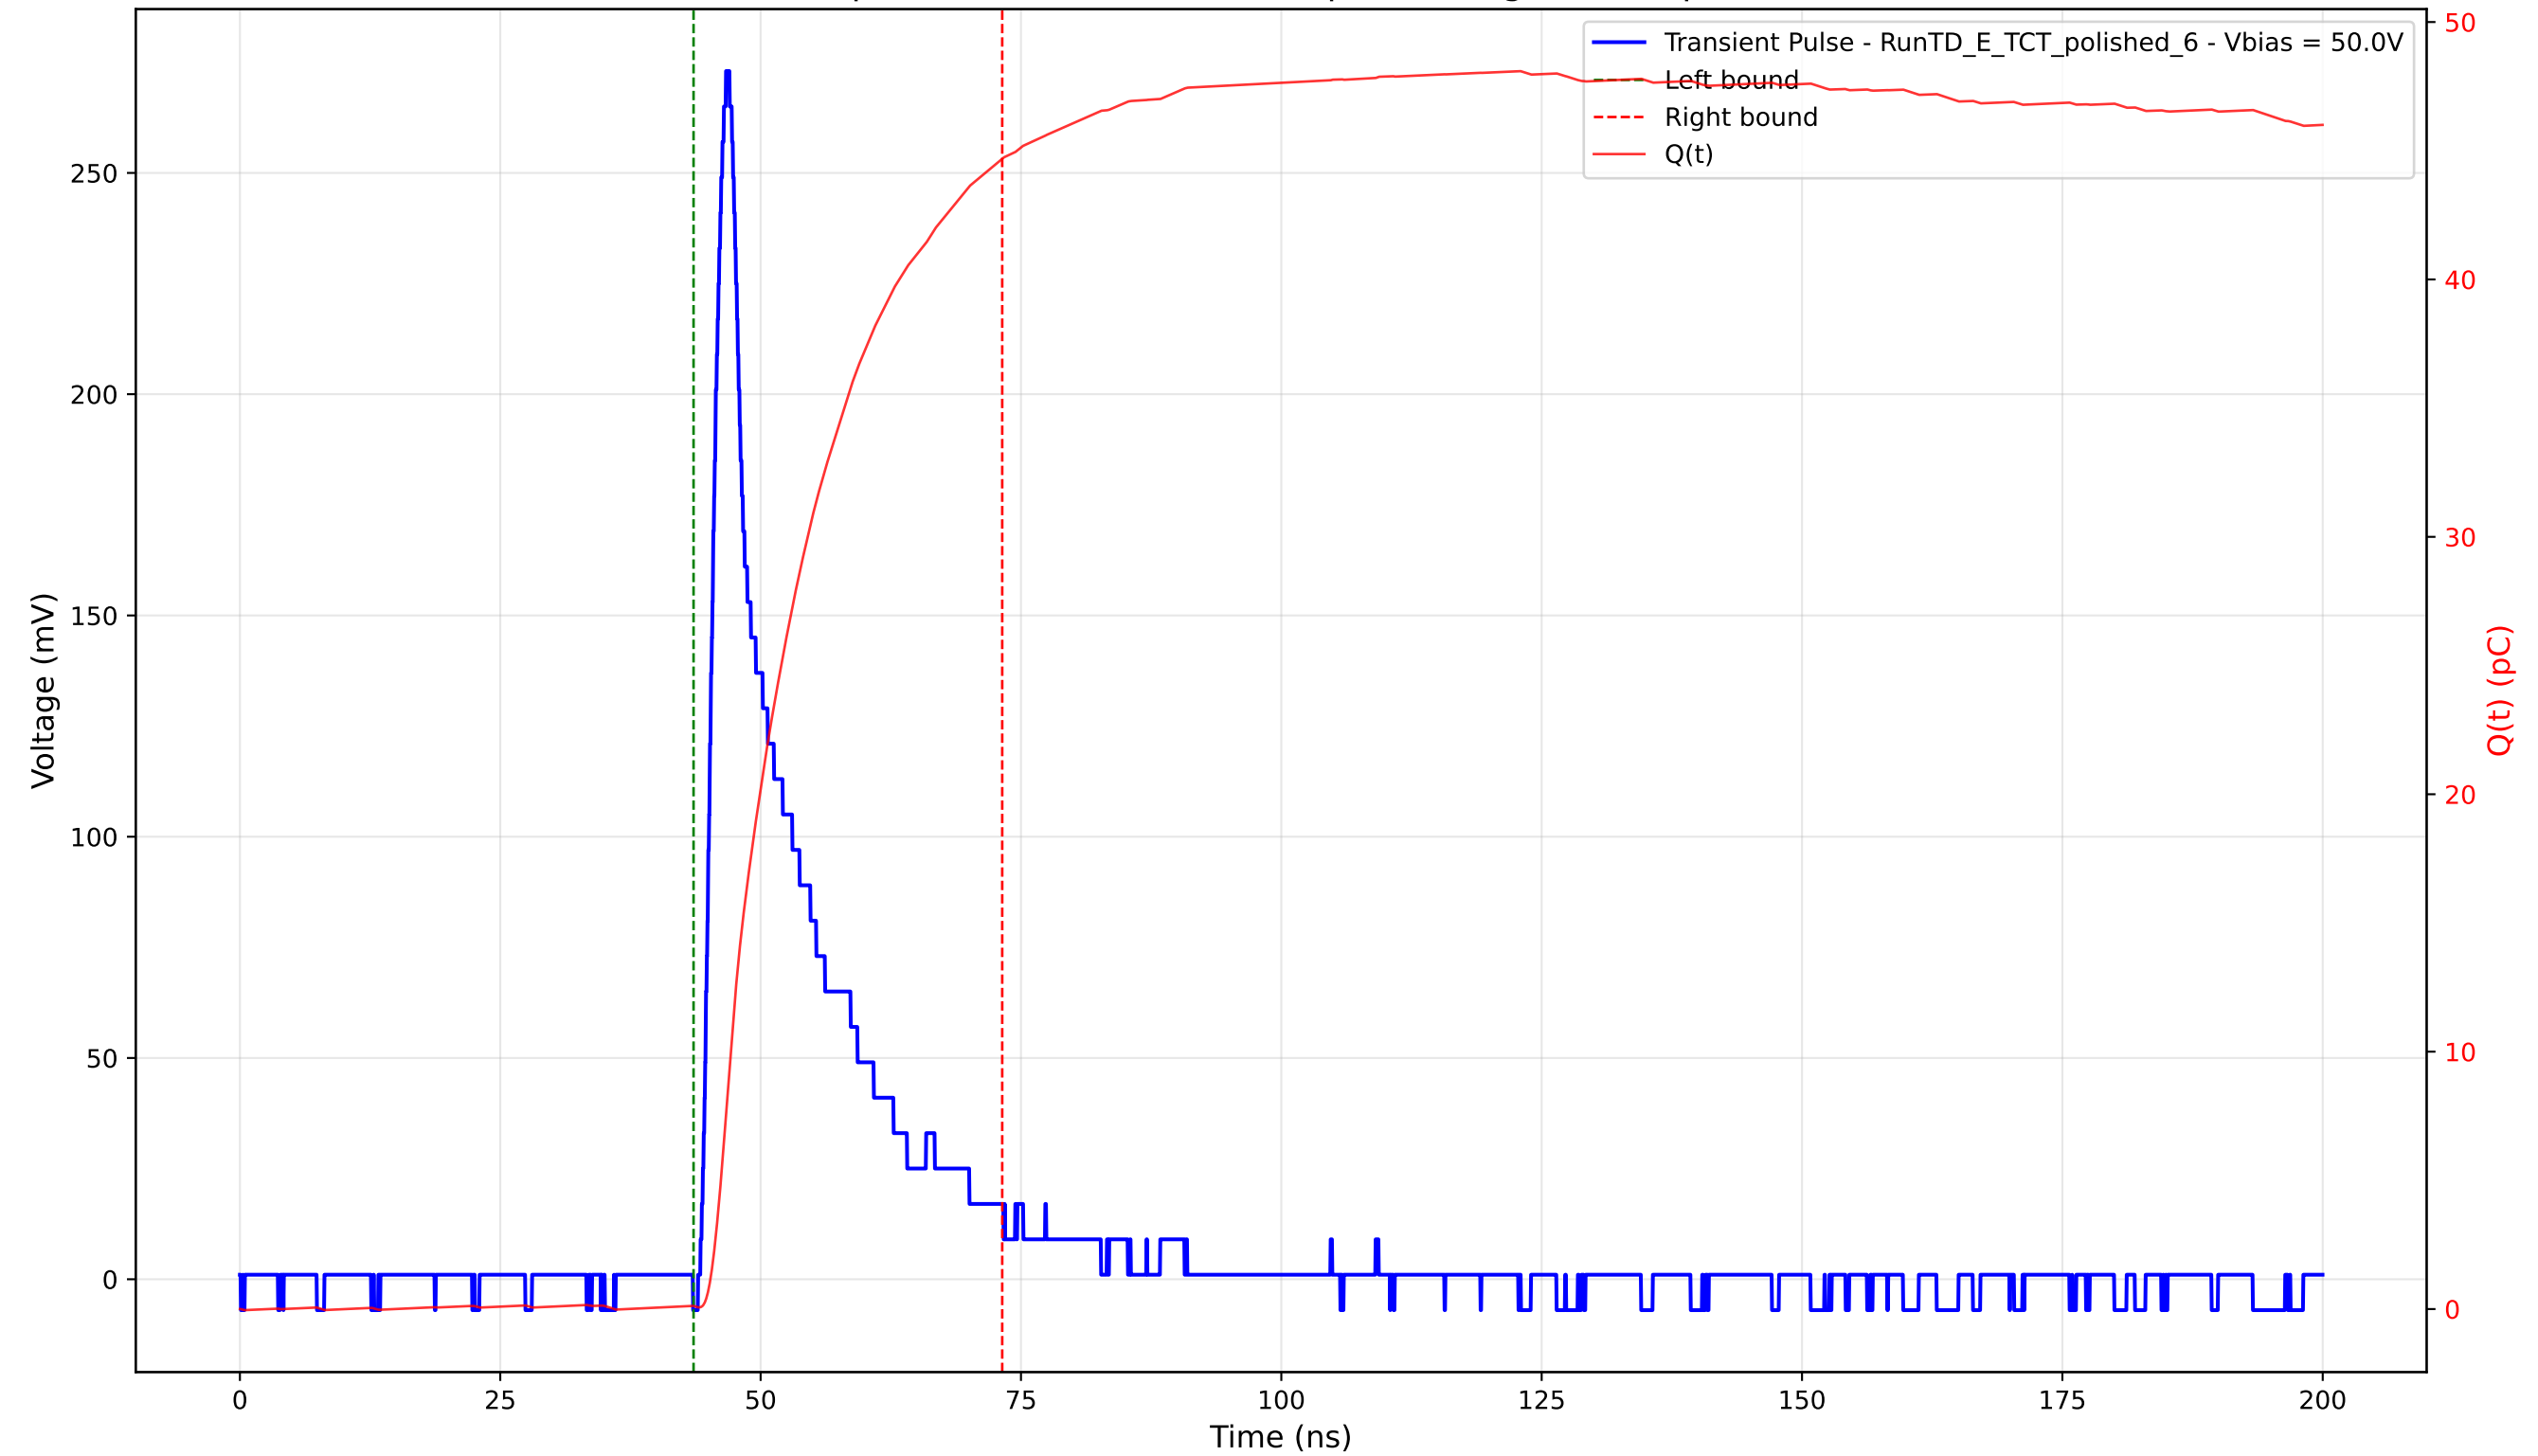


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 44.90 pC - Rise Time: 1.90 ns

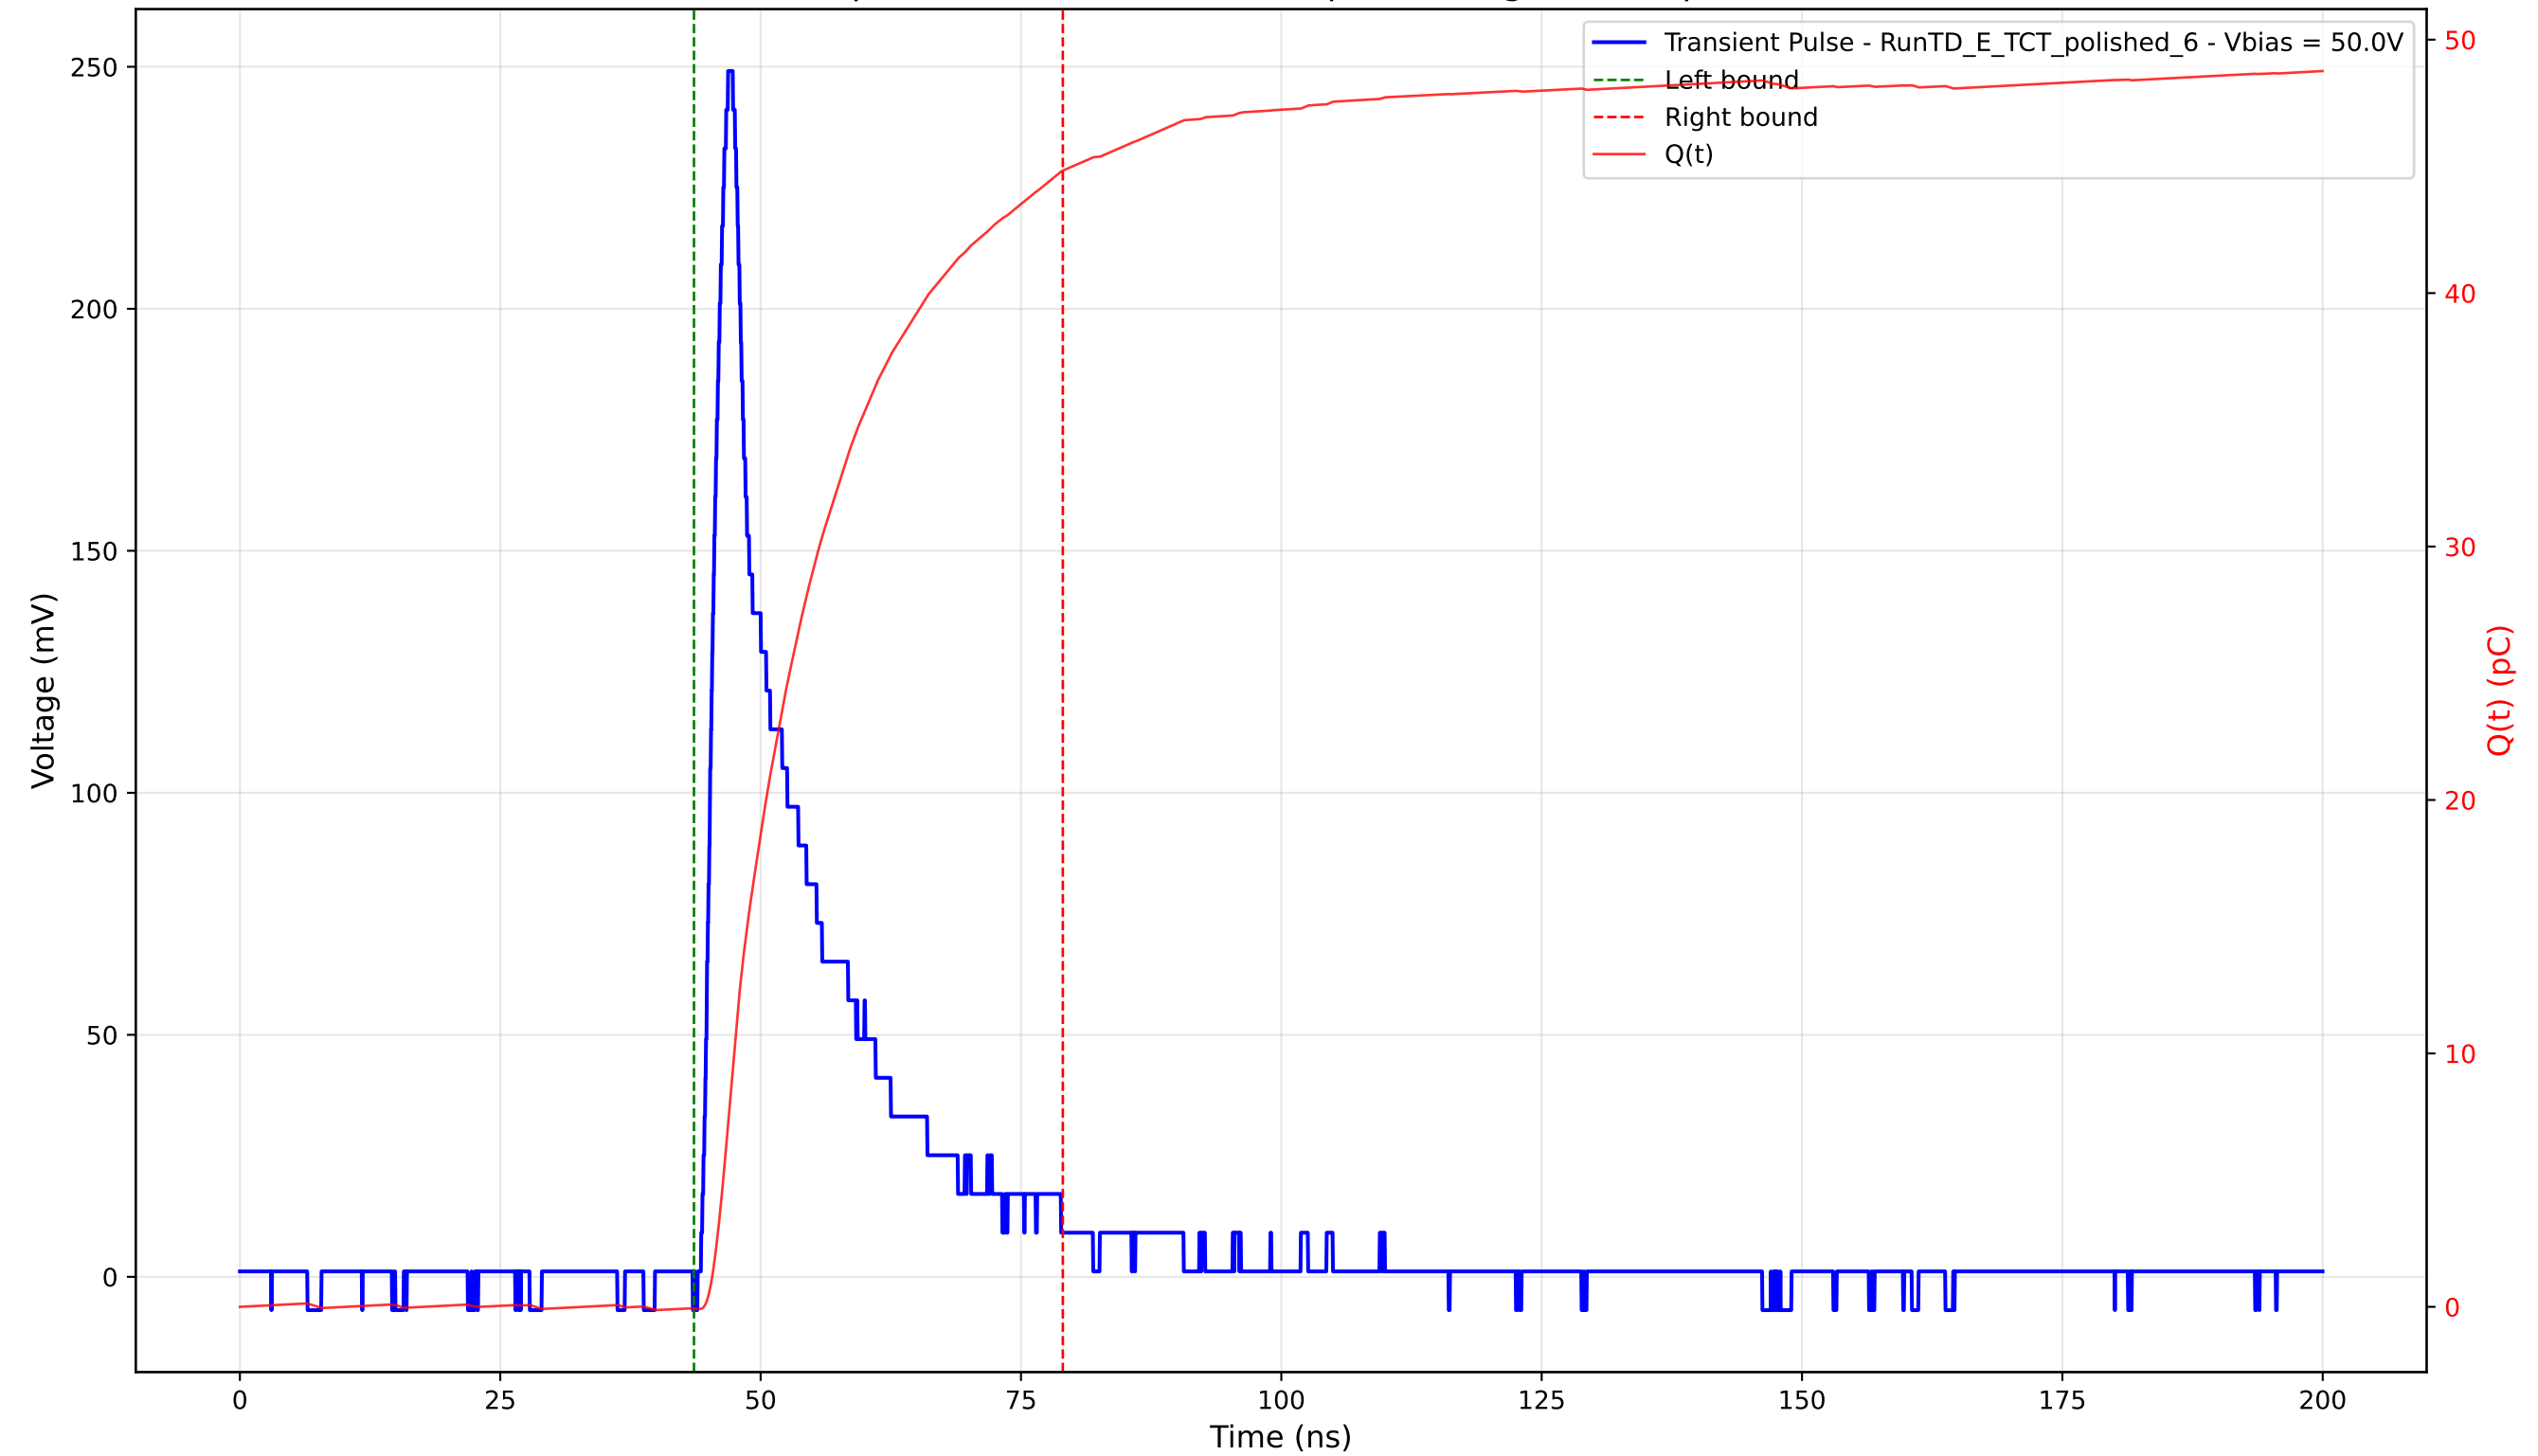


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 43.00 pC - Rise Time: 2.15 ns

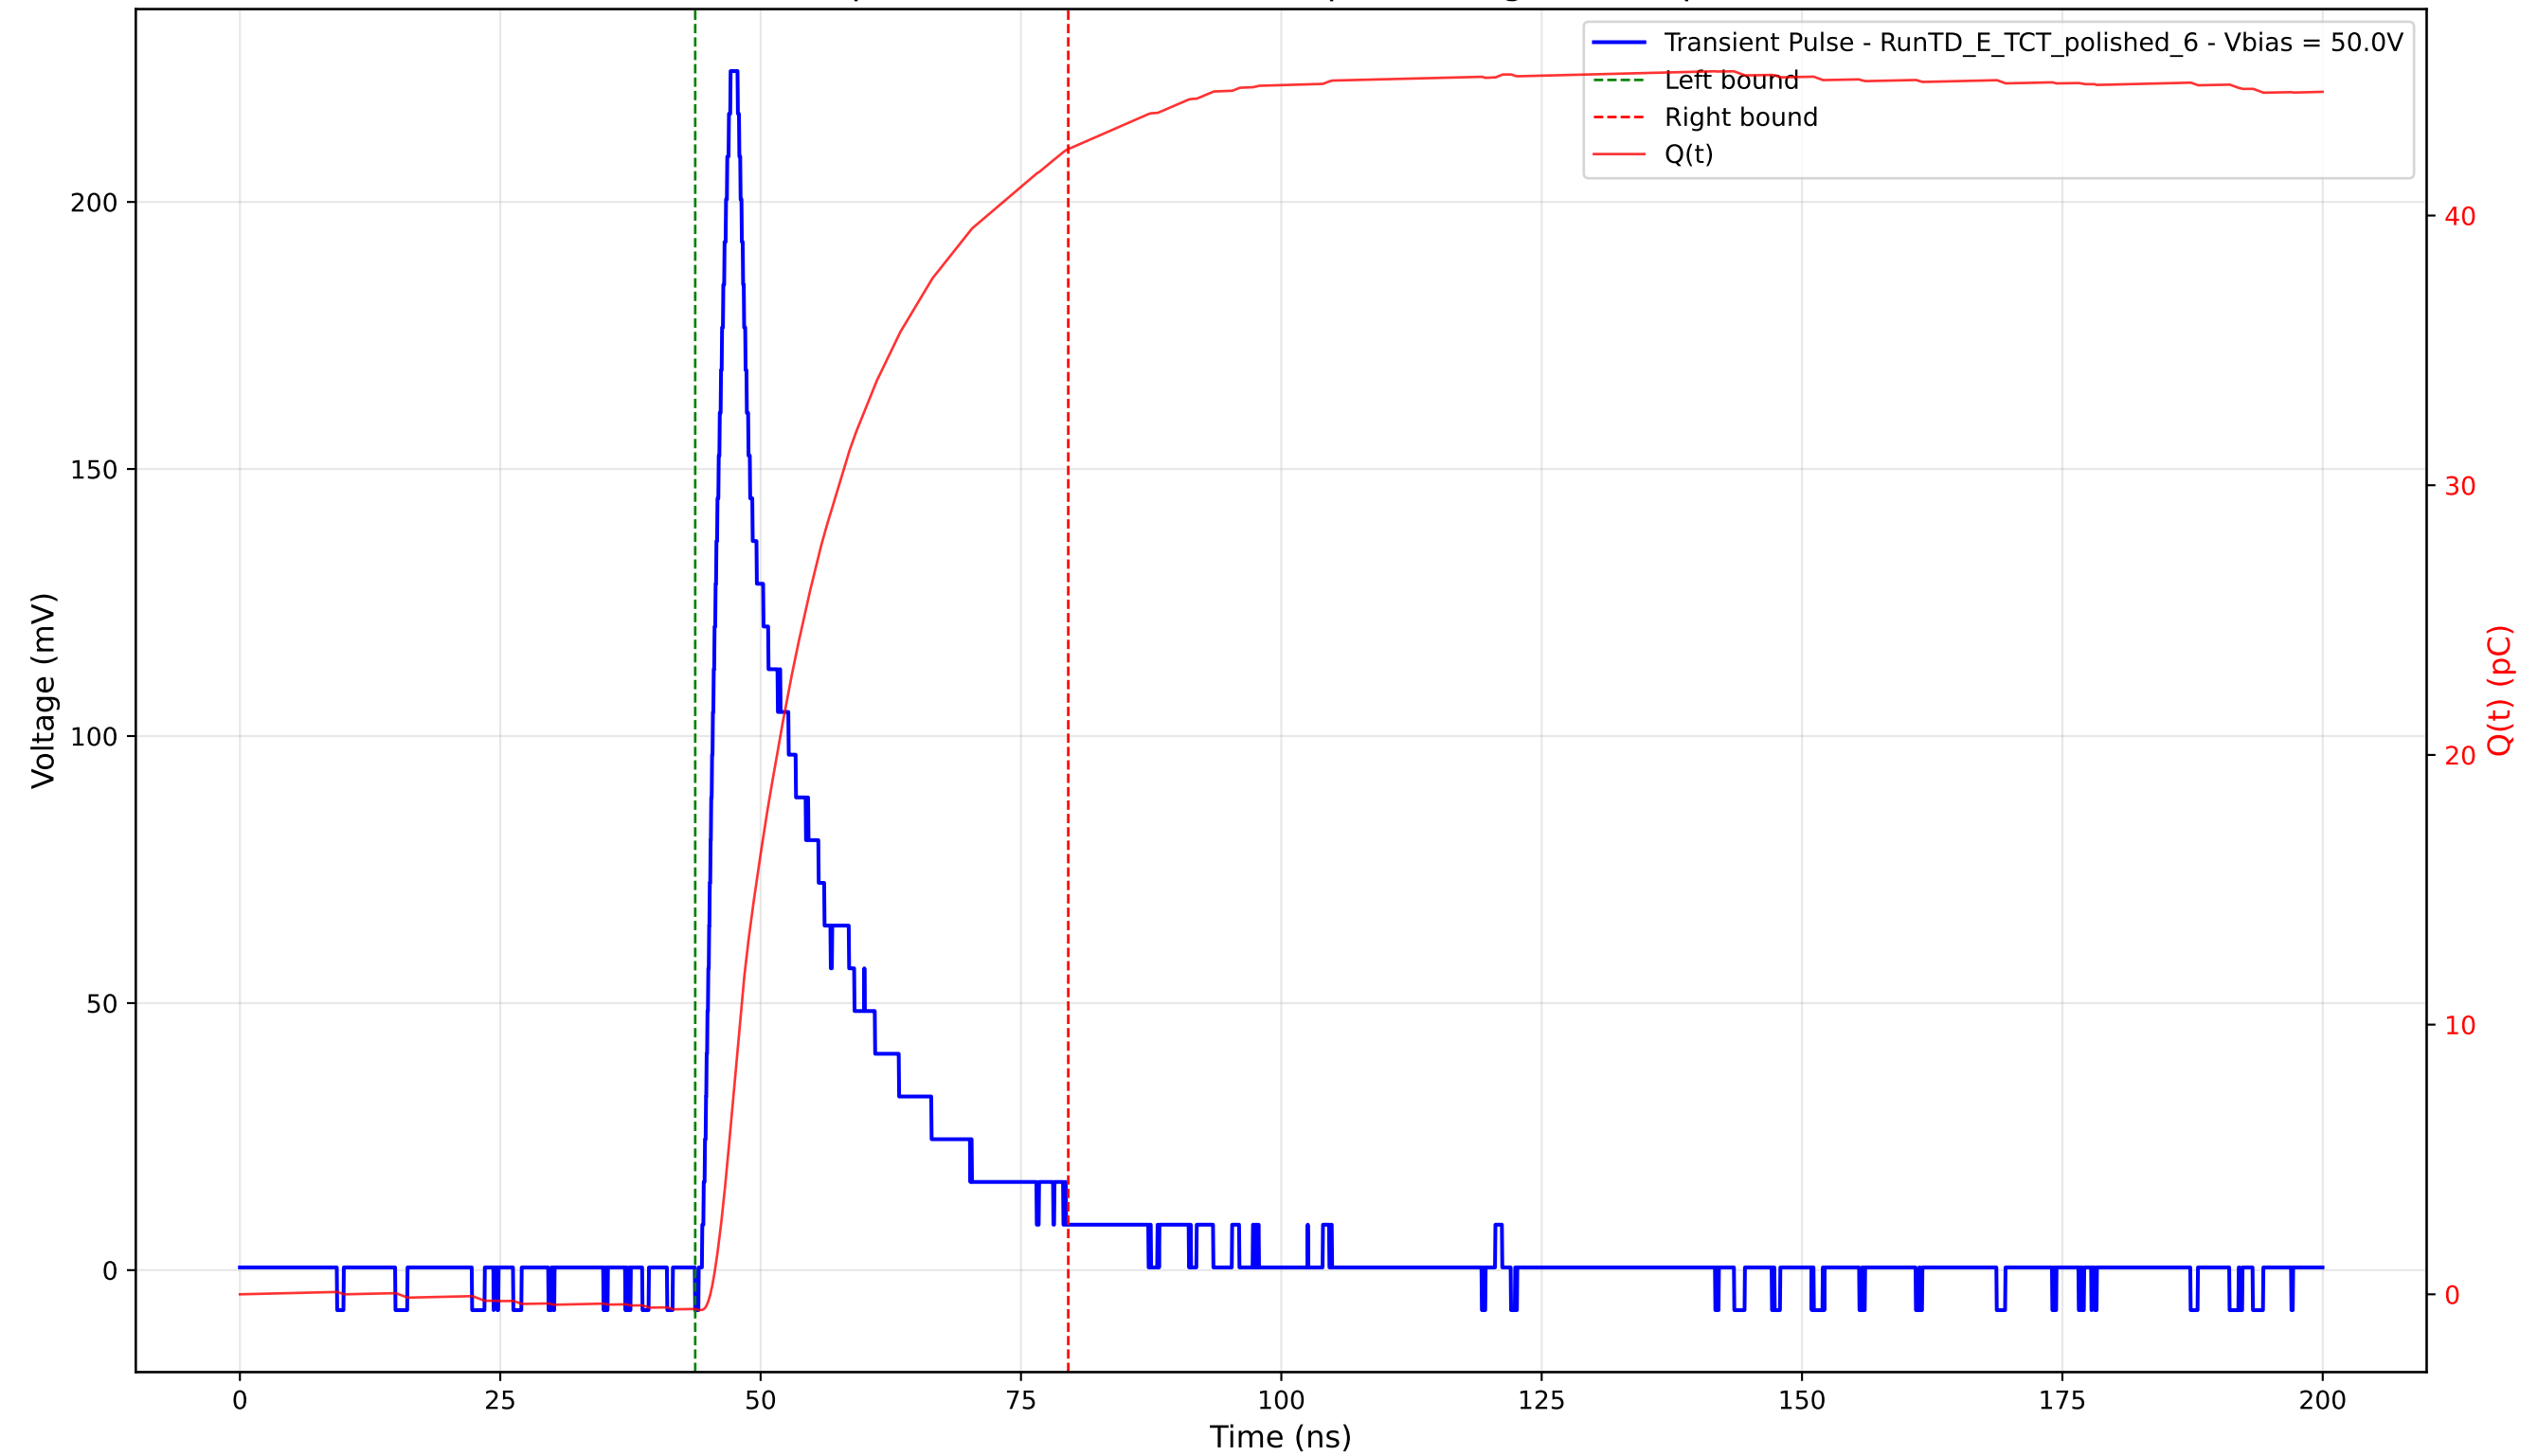


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 41.78 pC - Rise Time: 2.57 ns

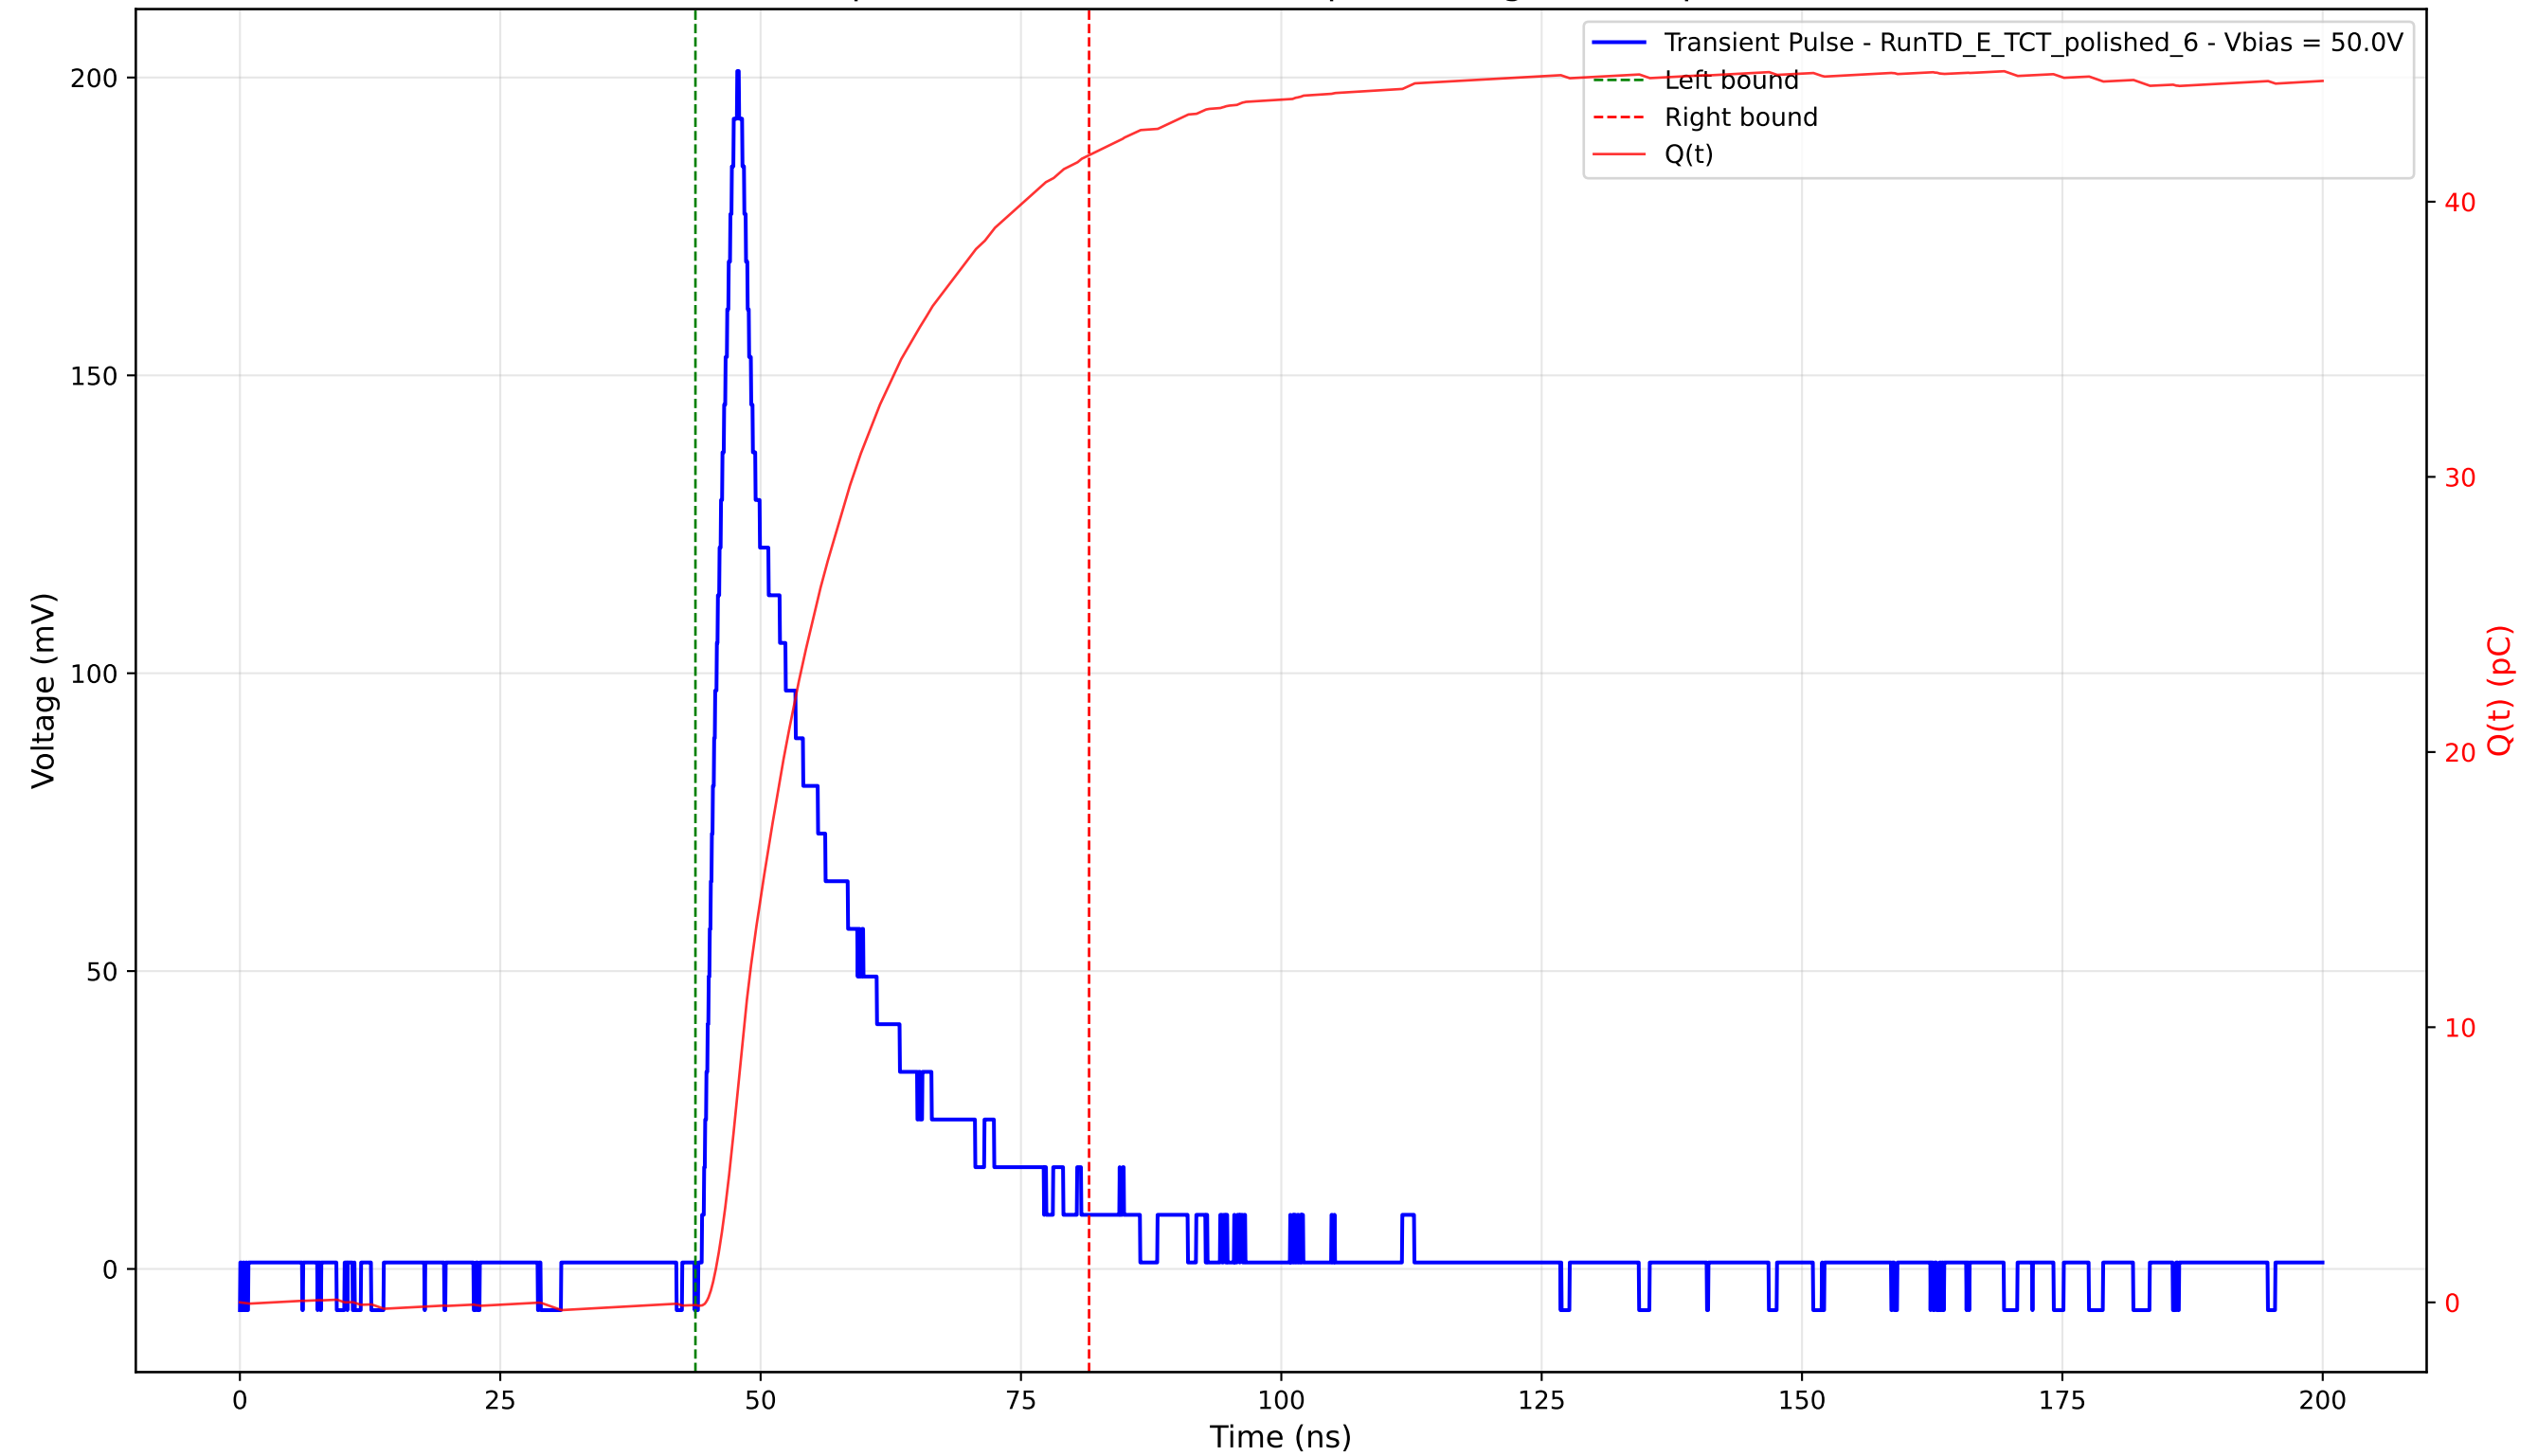


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 39.93 pC - Rise Time: 2.90 ns

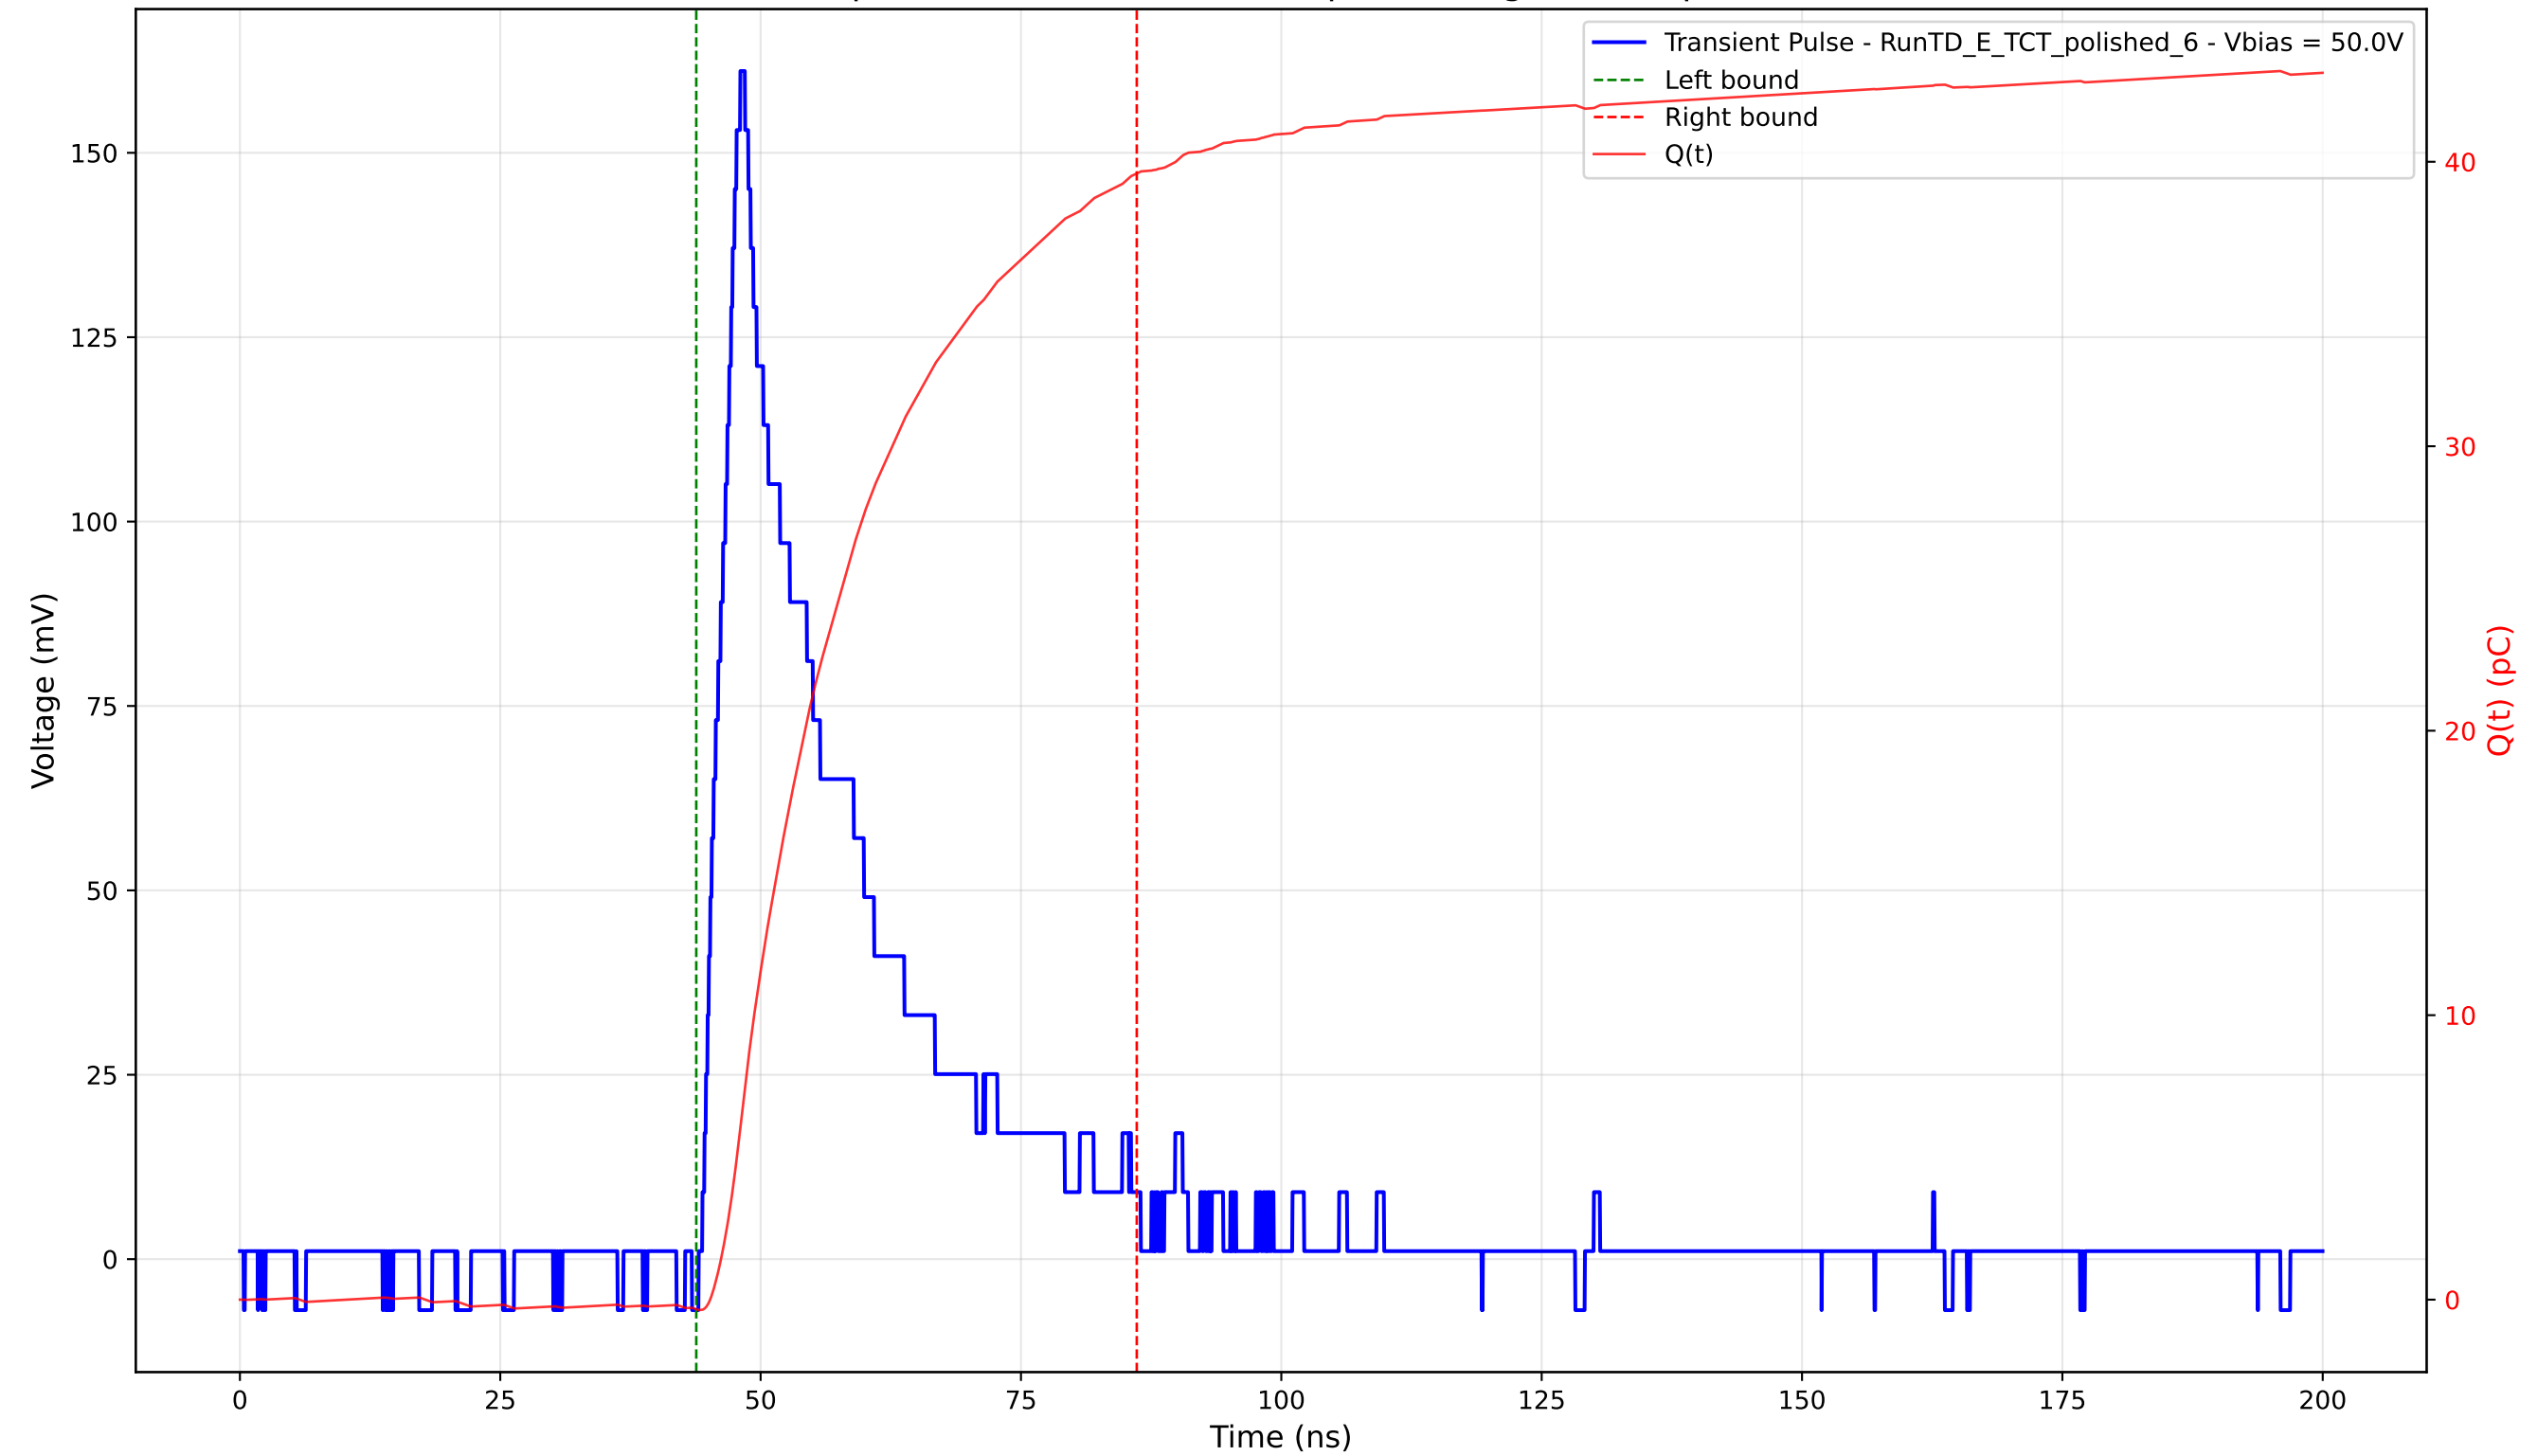


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 34.82 pC - Rise Time: 2.74 ns

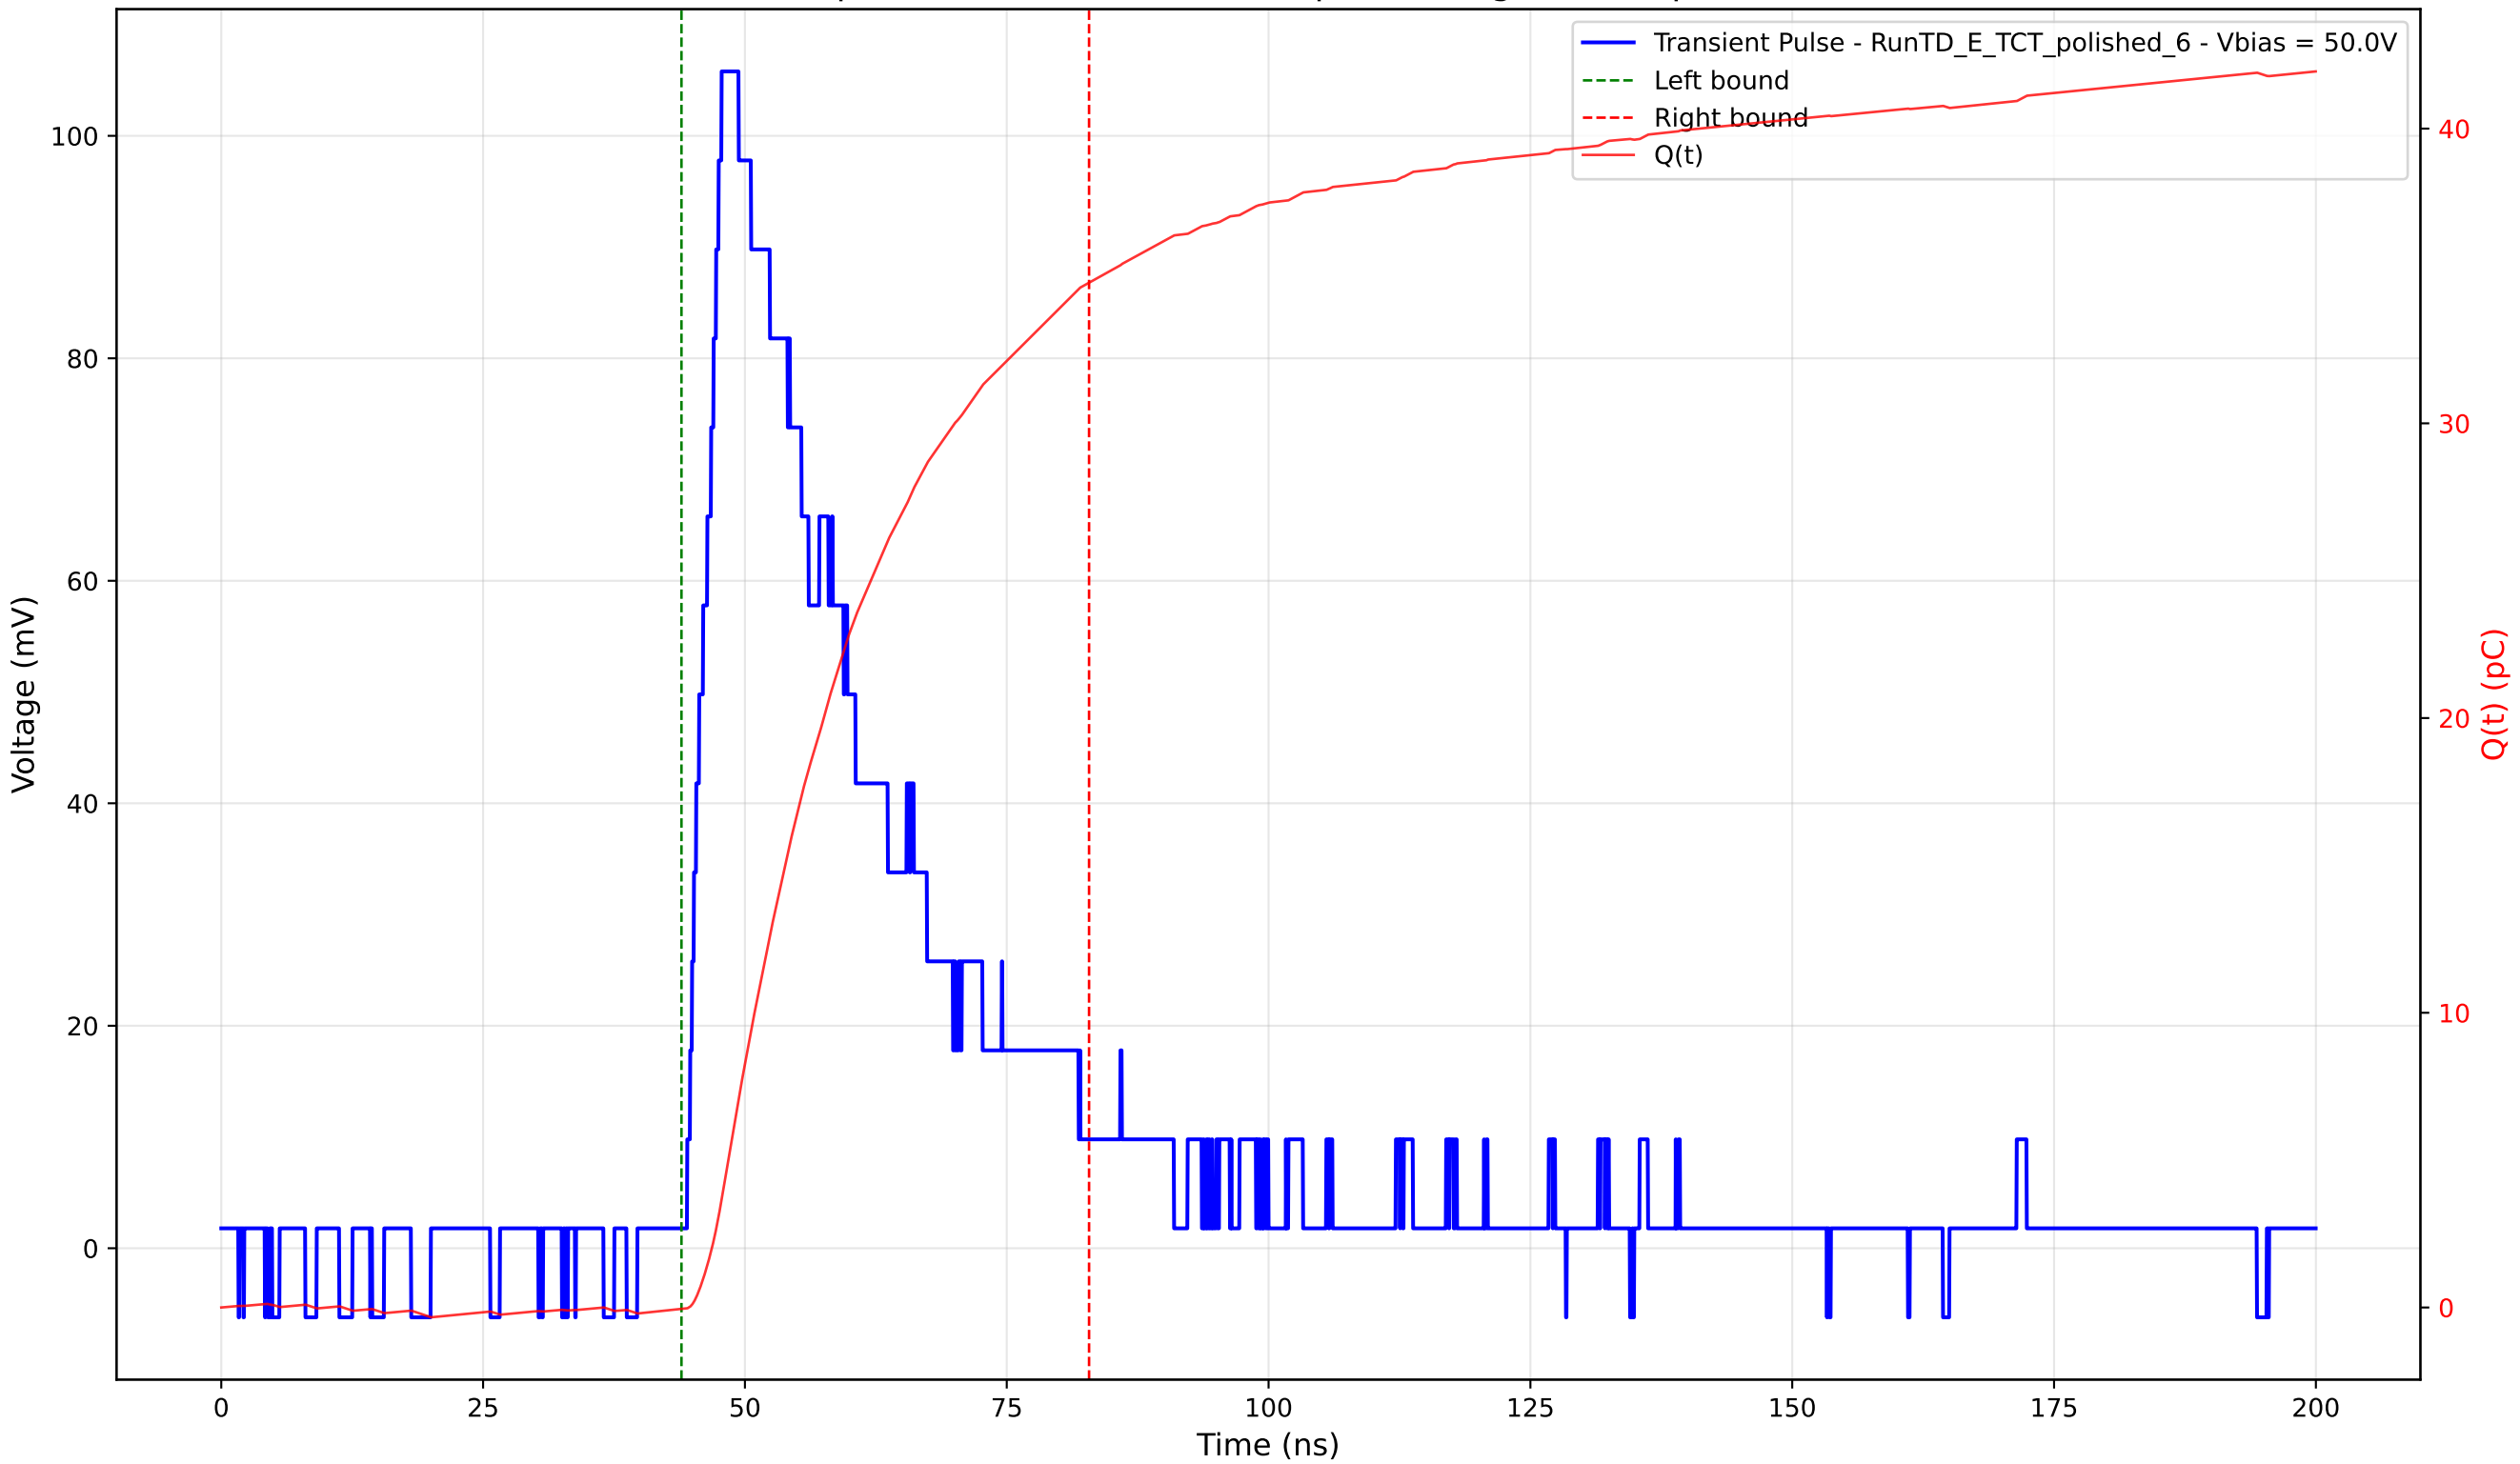


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 33.76 pC - Rise Time: 5.98 ns

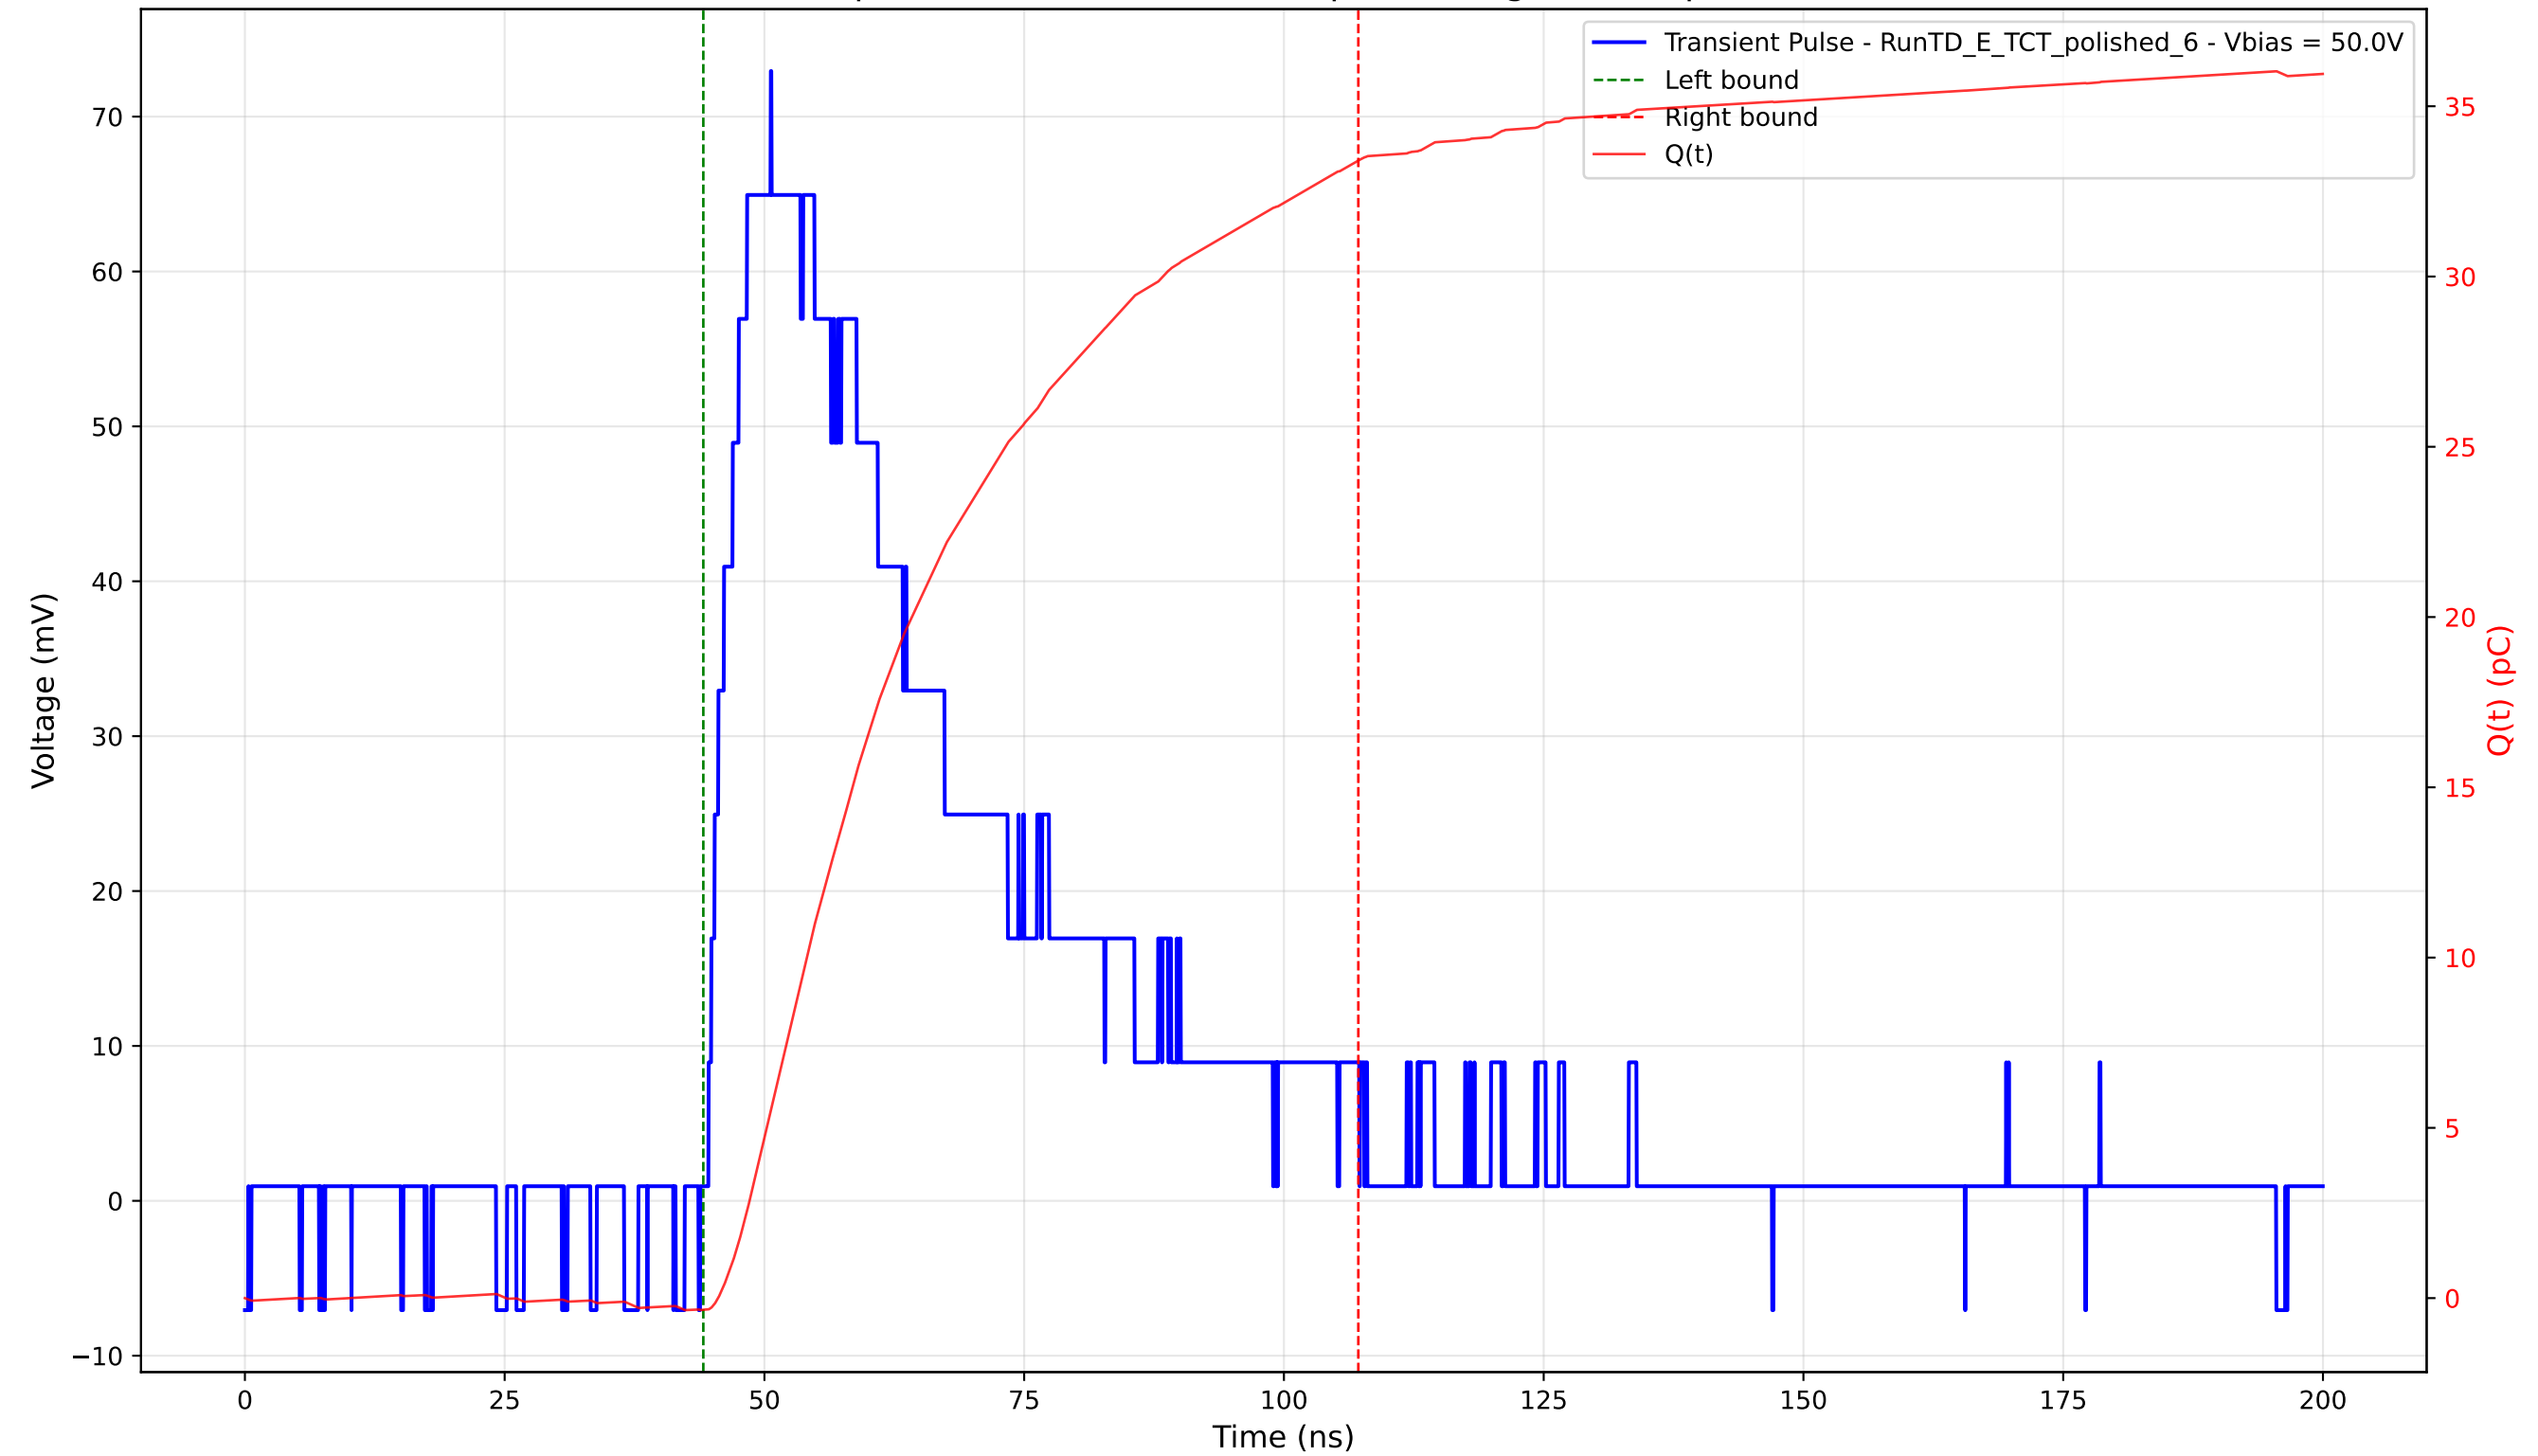


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 24.73 pC - Rise Time: 6.36 ns

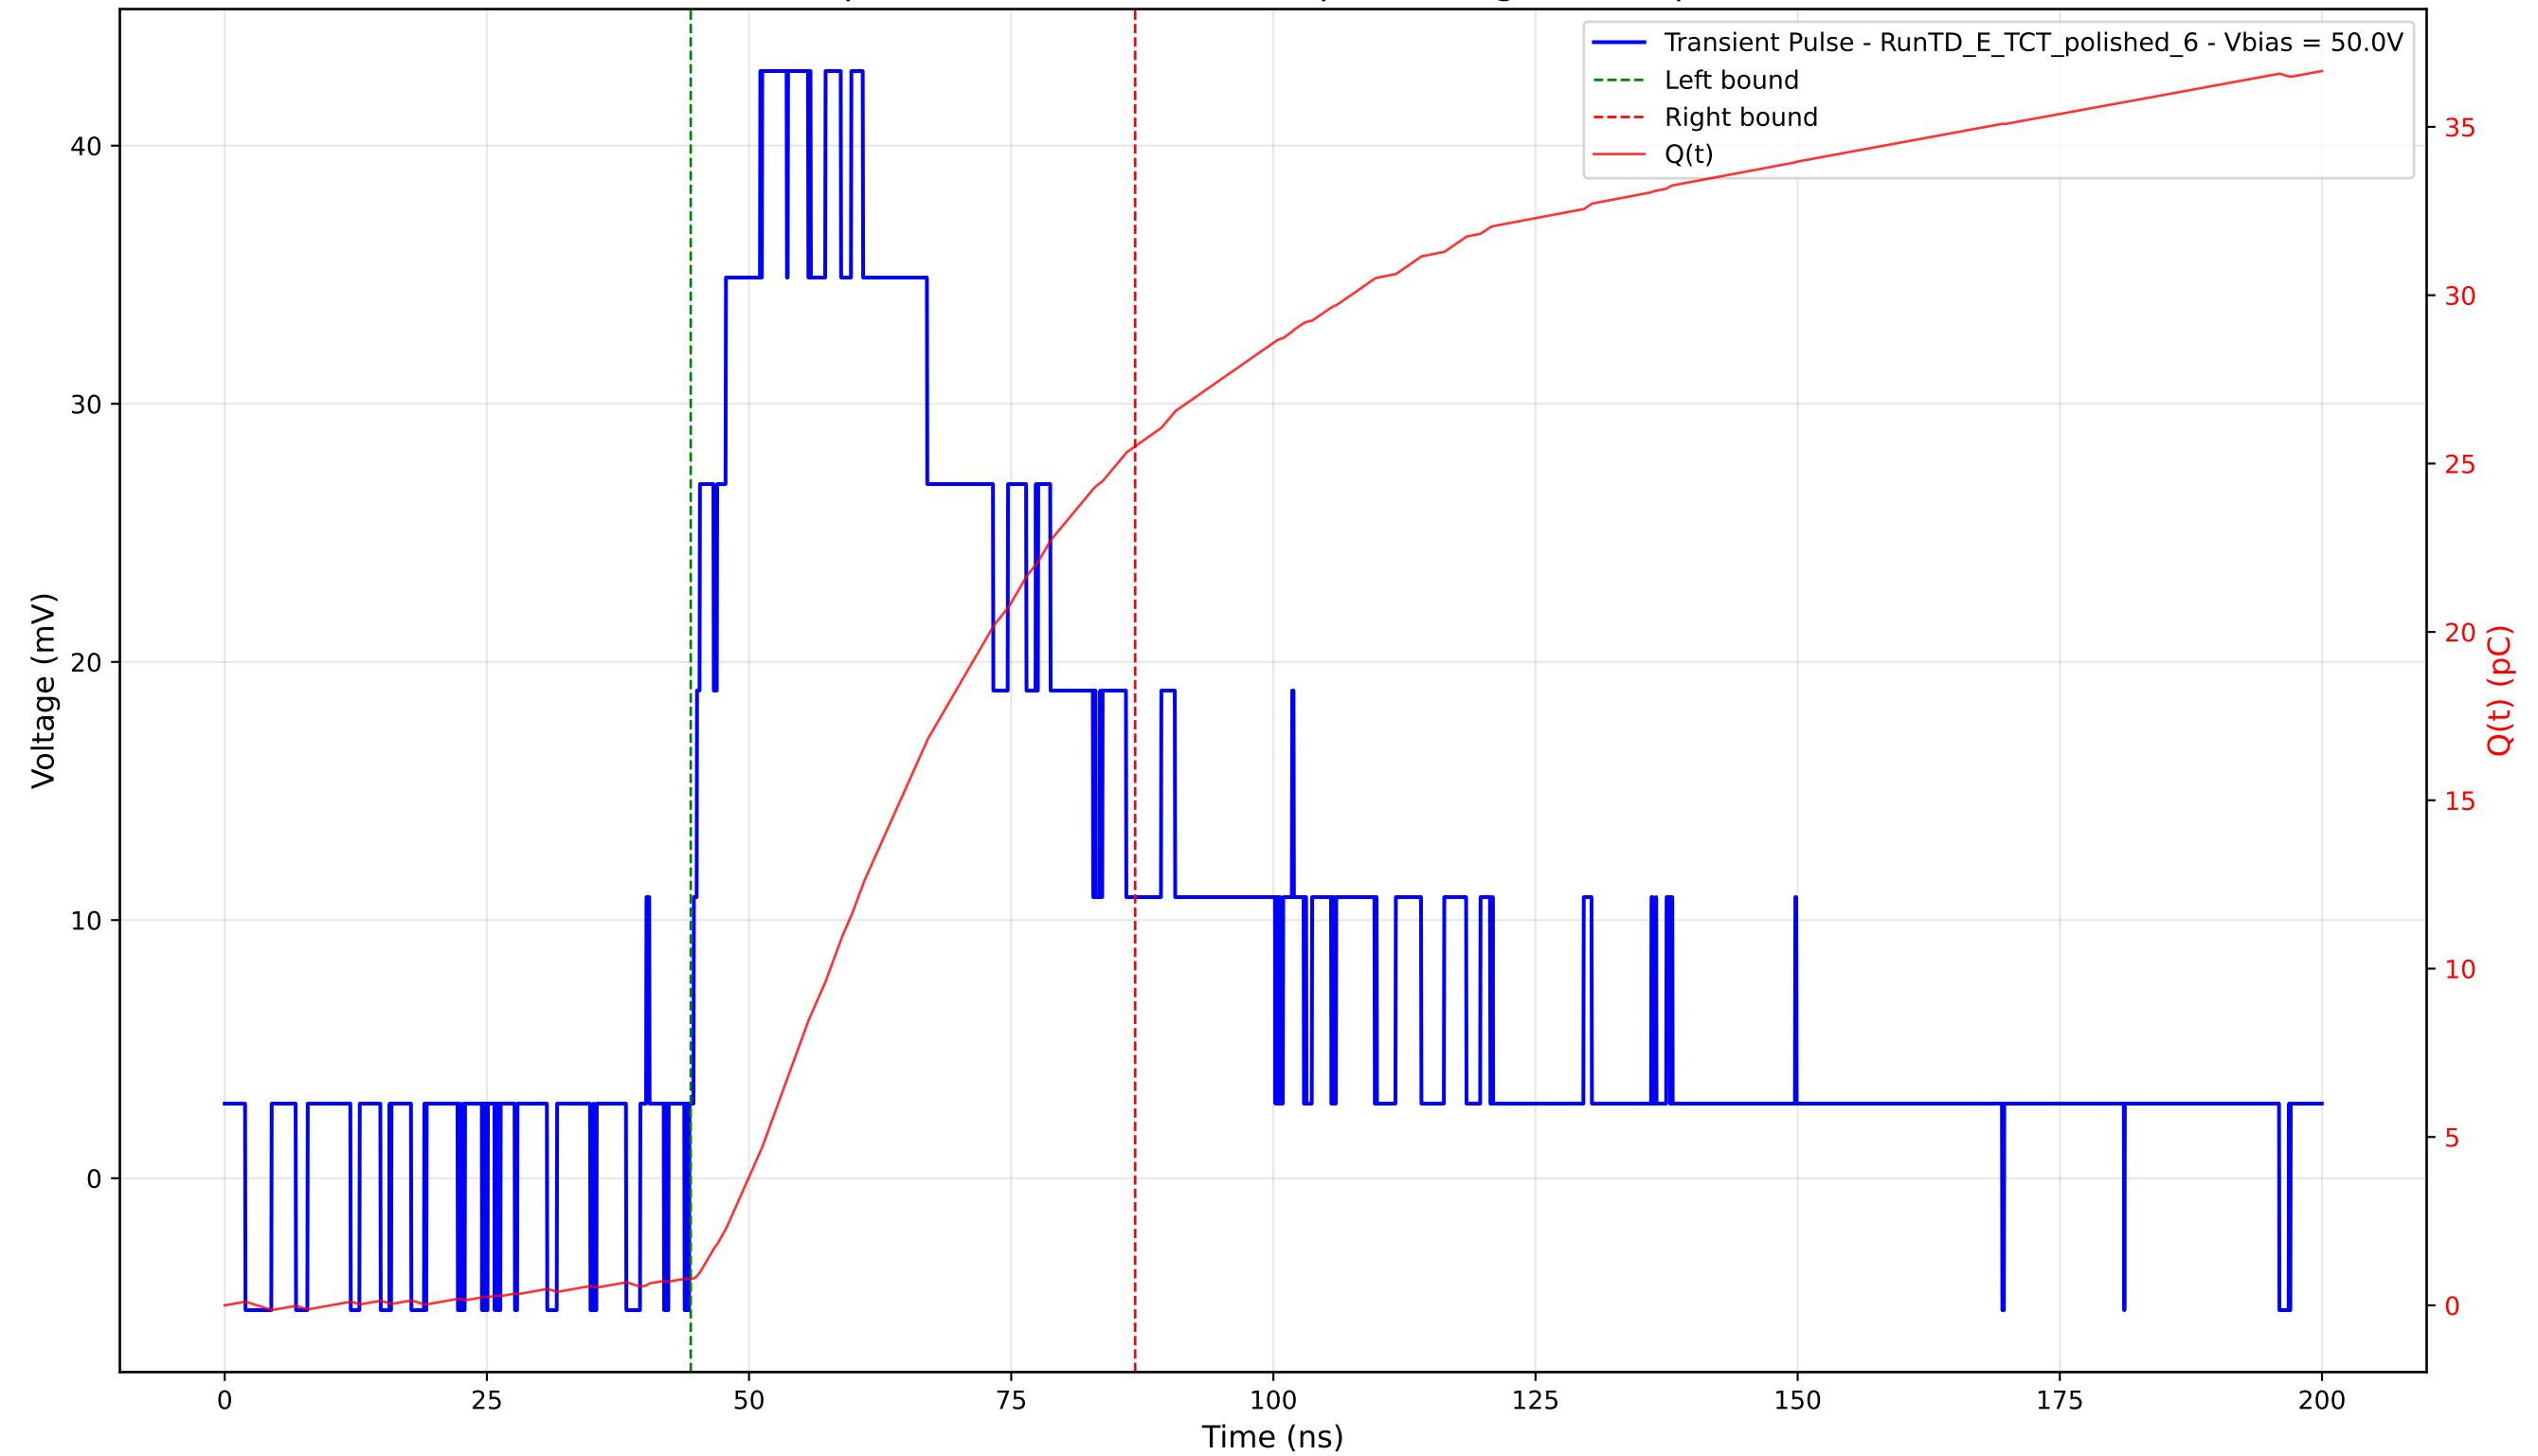


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 22.97 pC - Rise Time: 13.44 ns

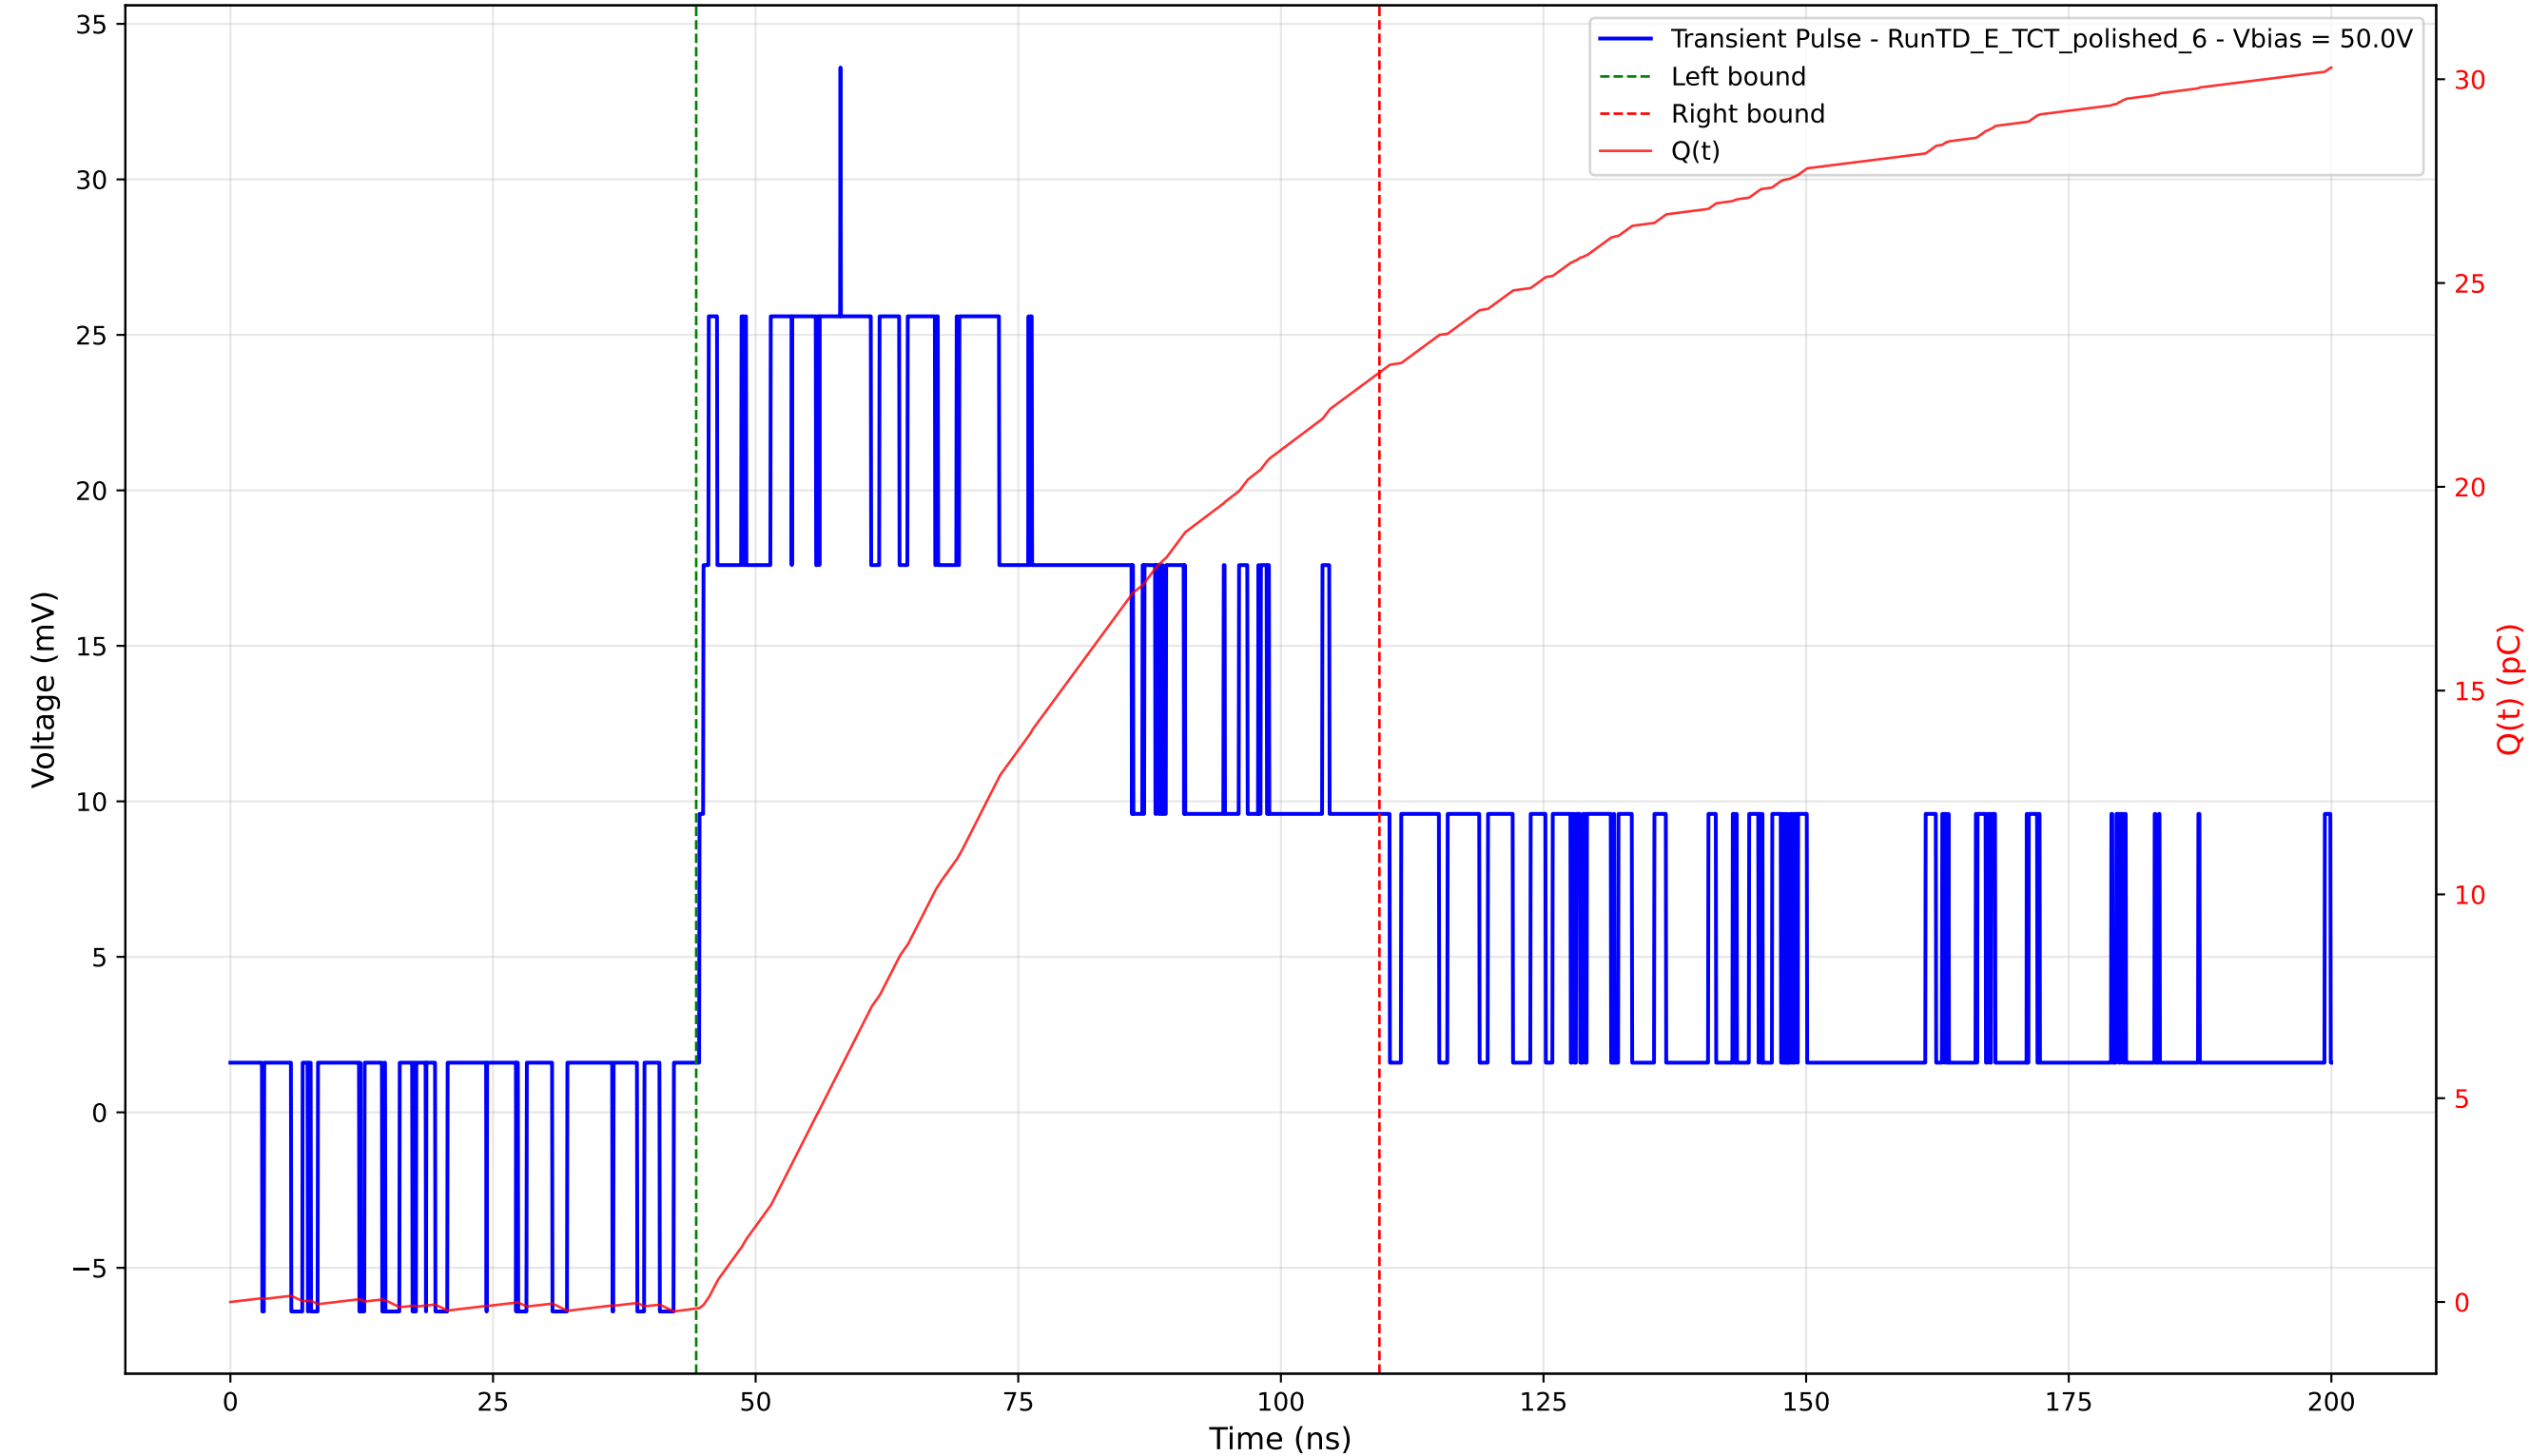


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 12.07 pC - Rise Time: 0.75 ns

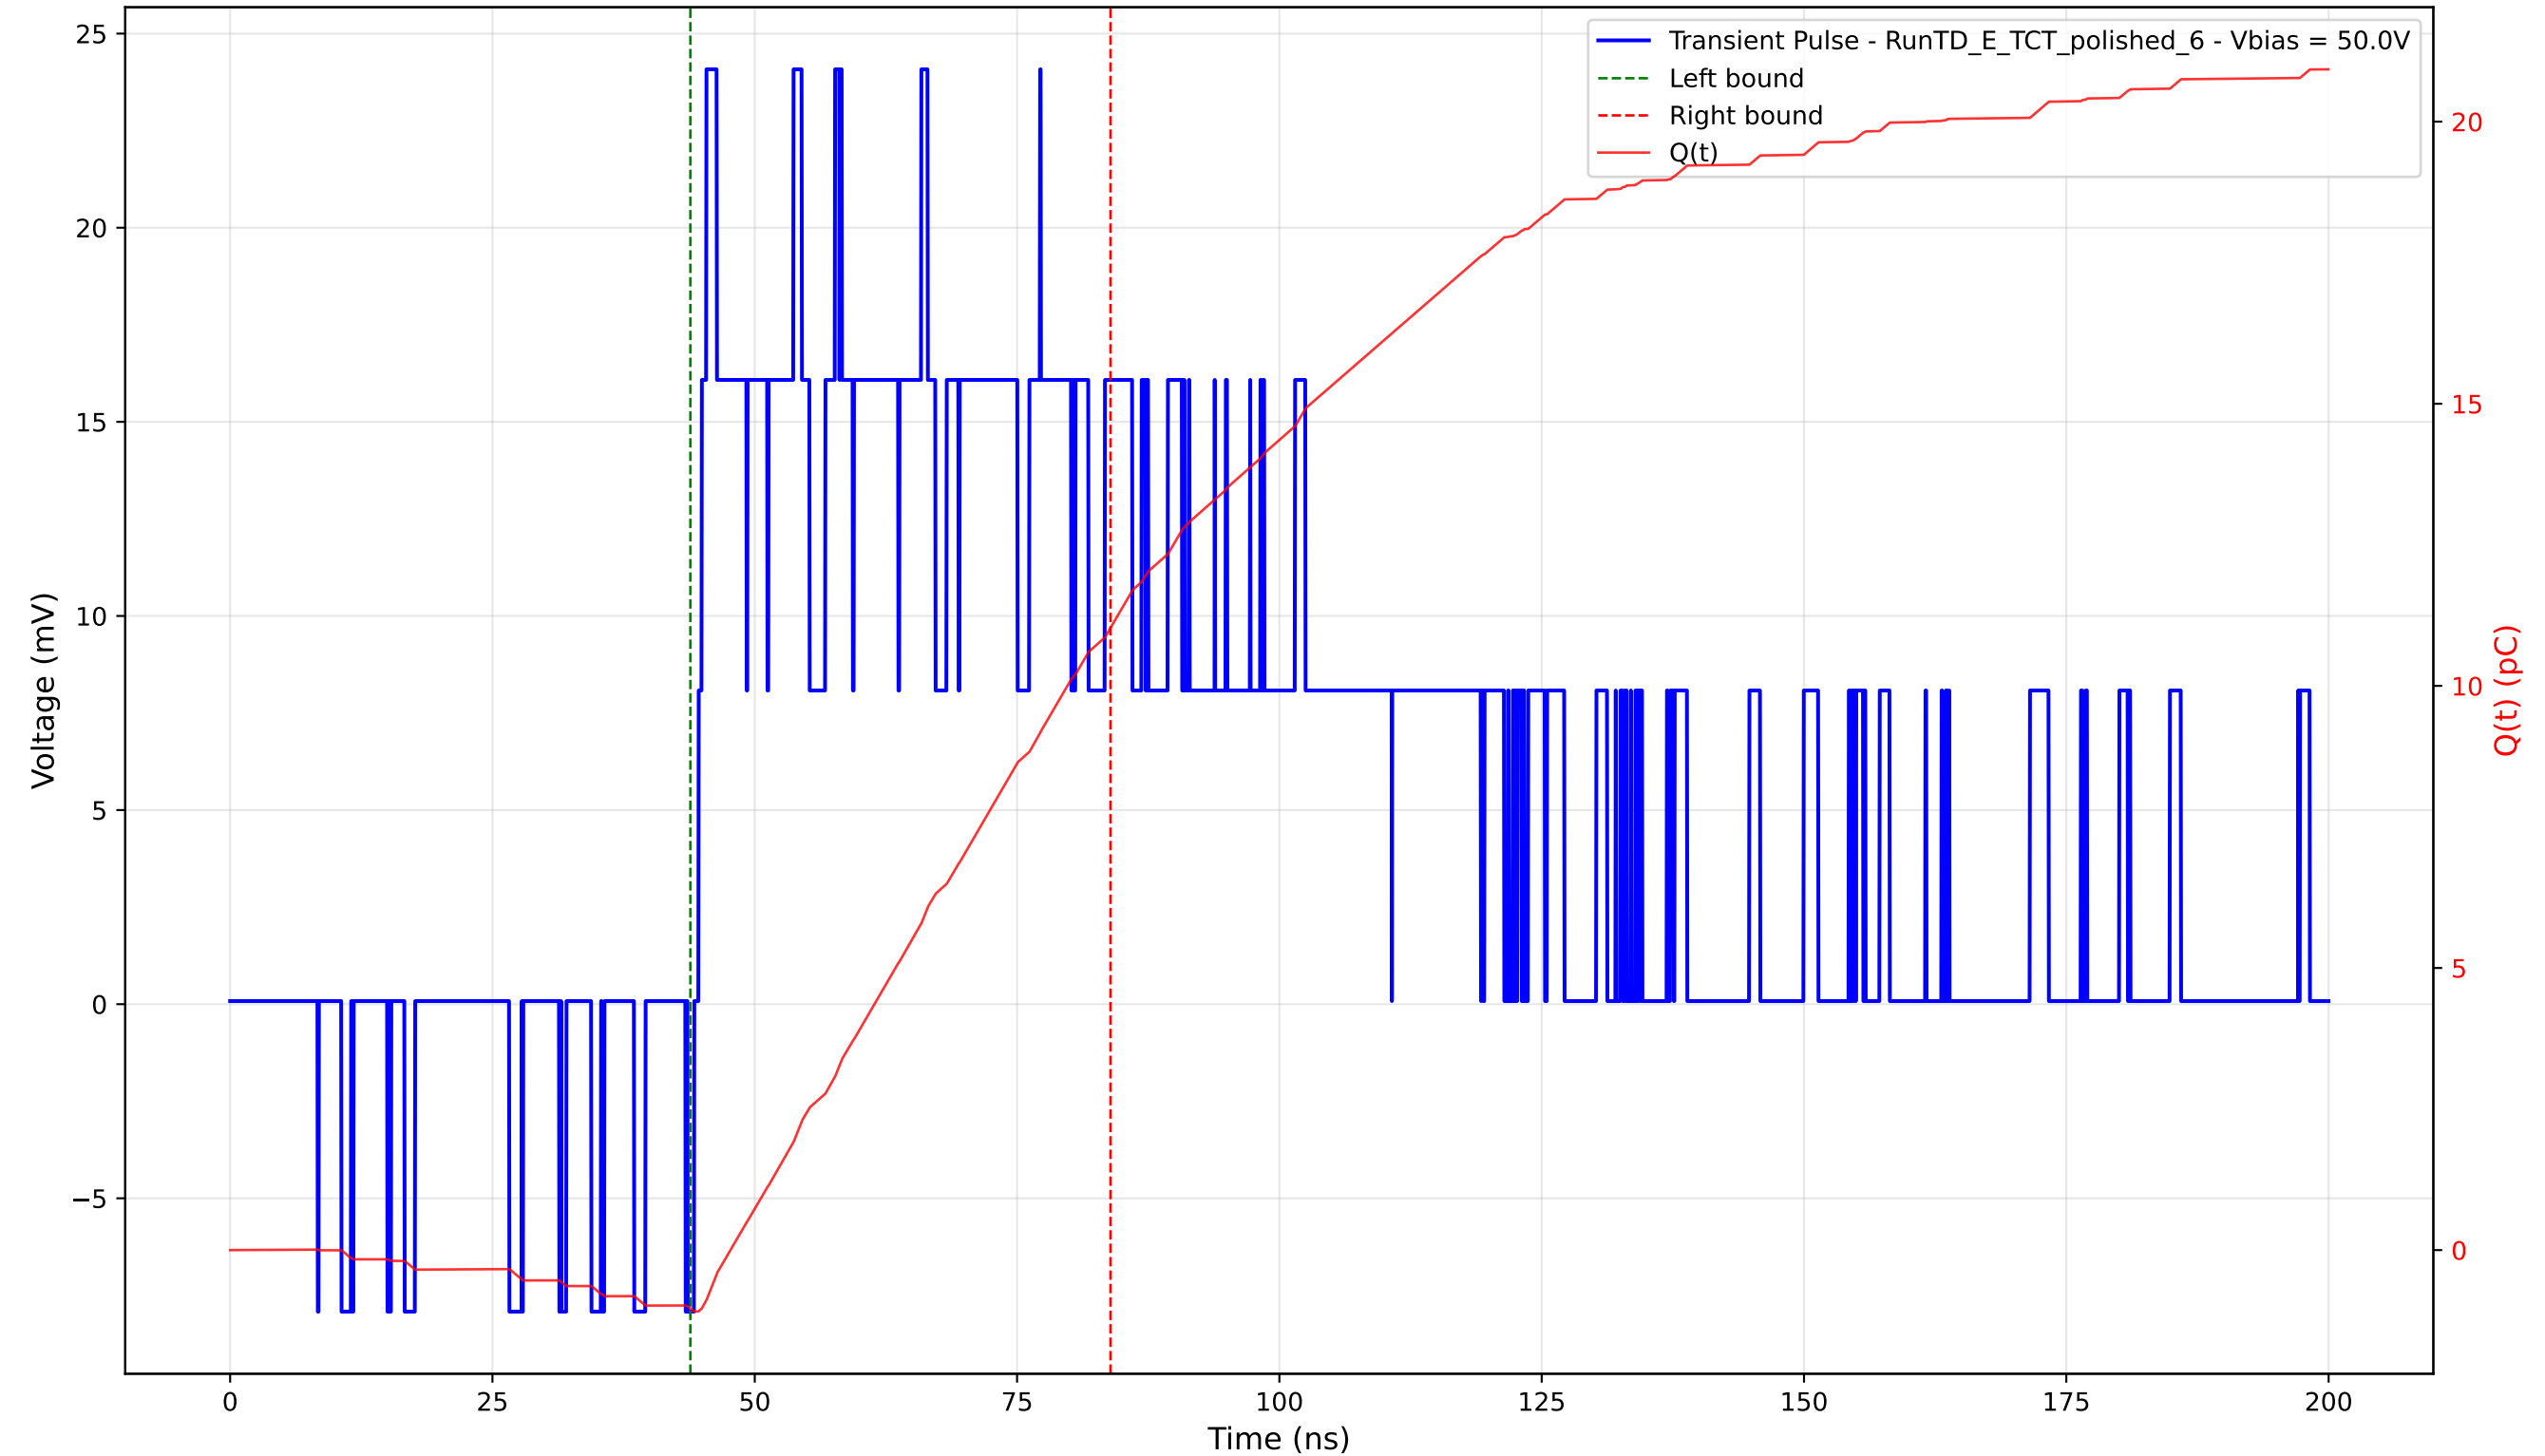


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 8.05 pC - Rise Time: 0.95 ns

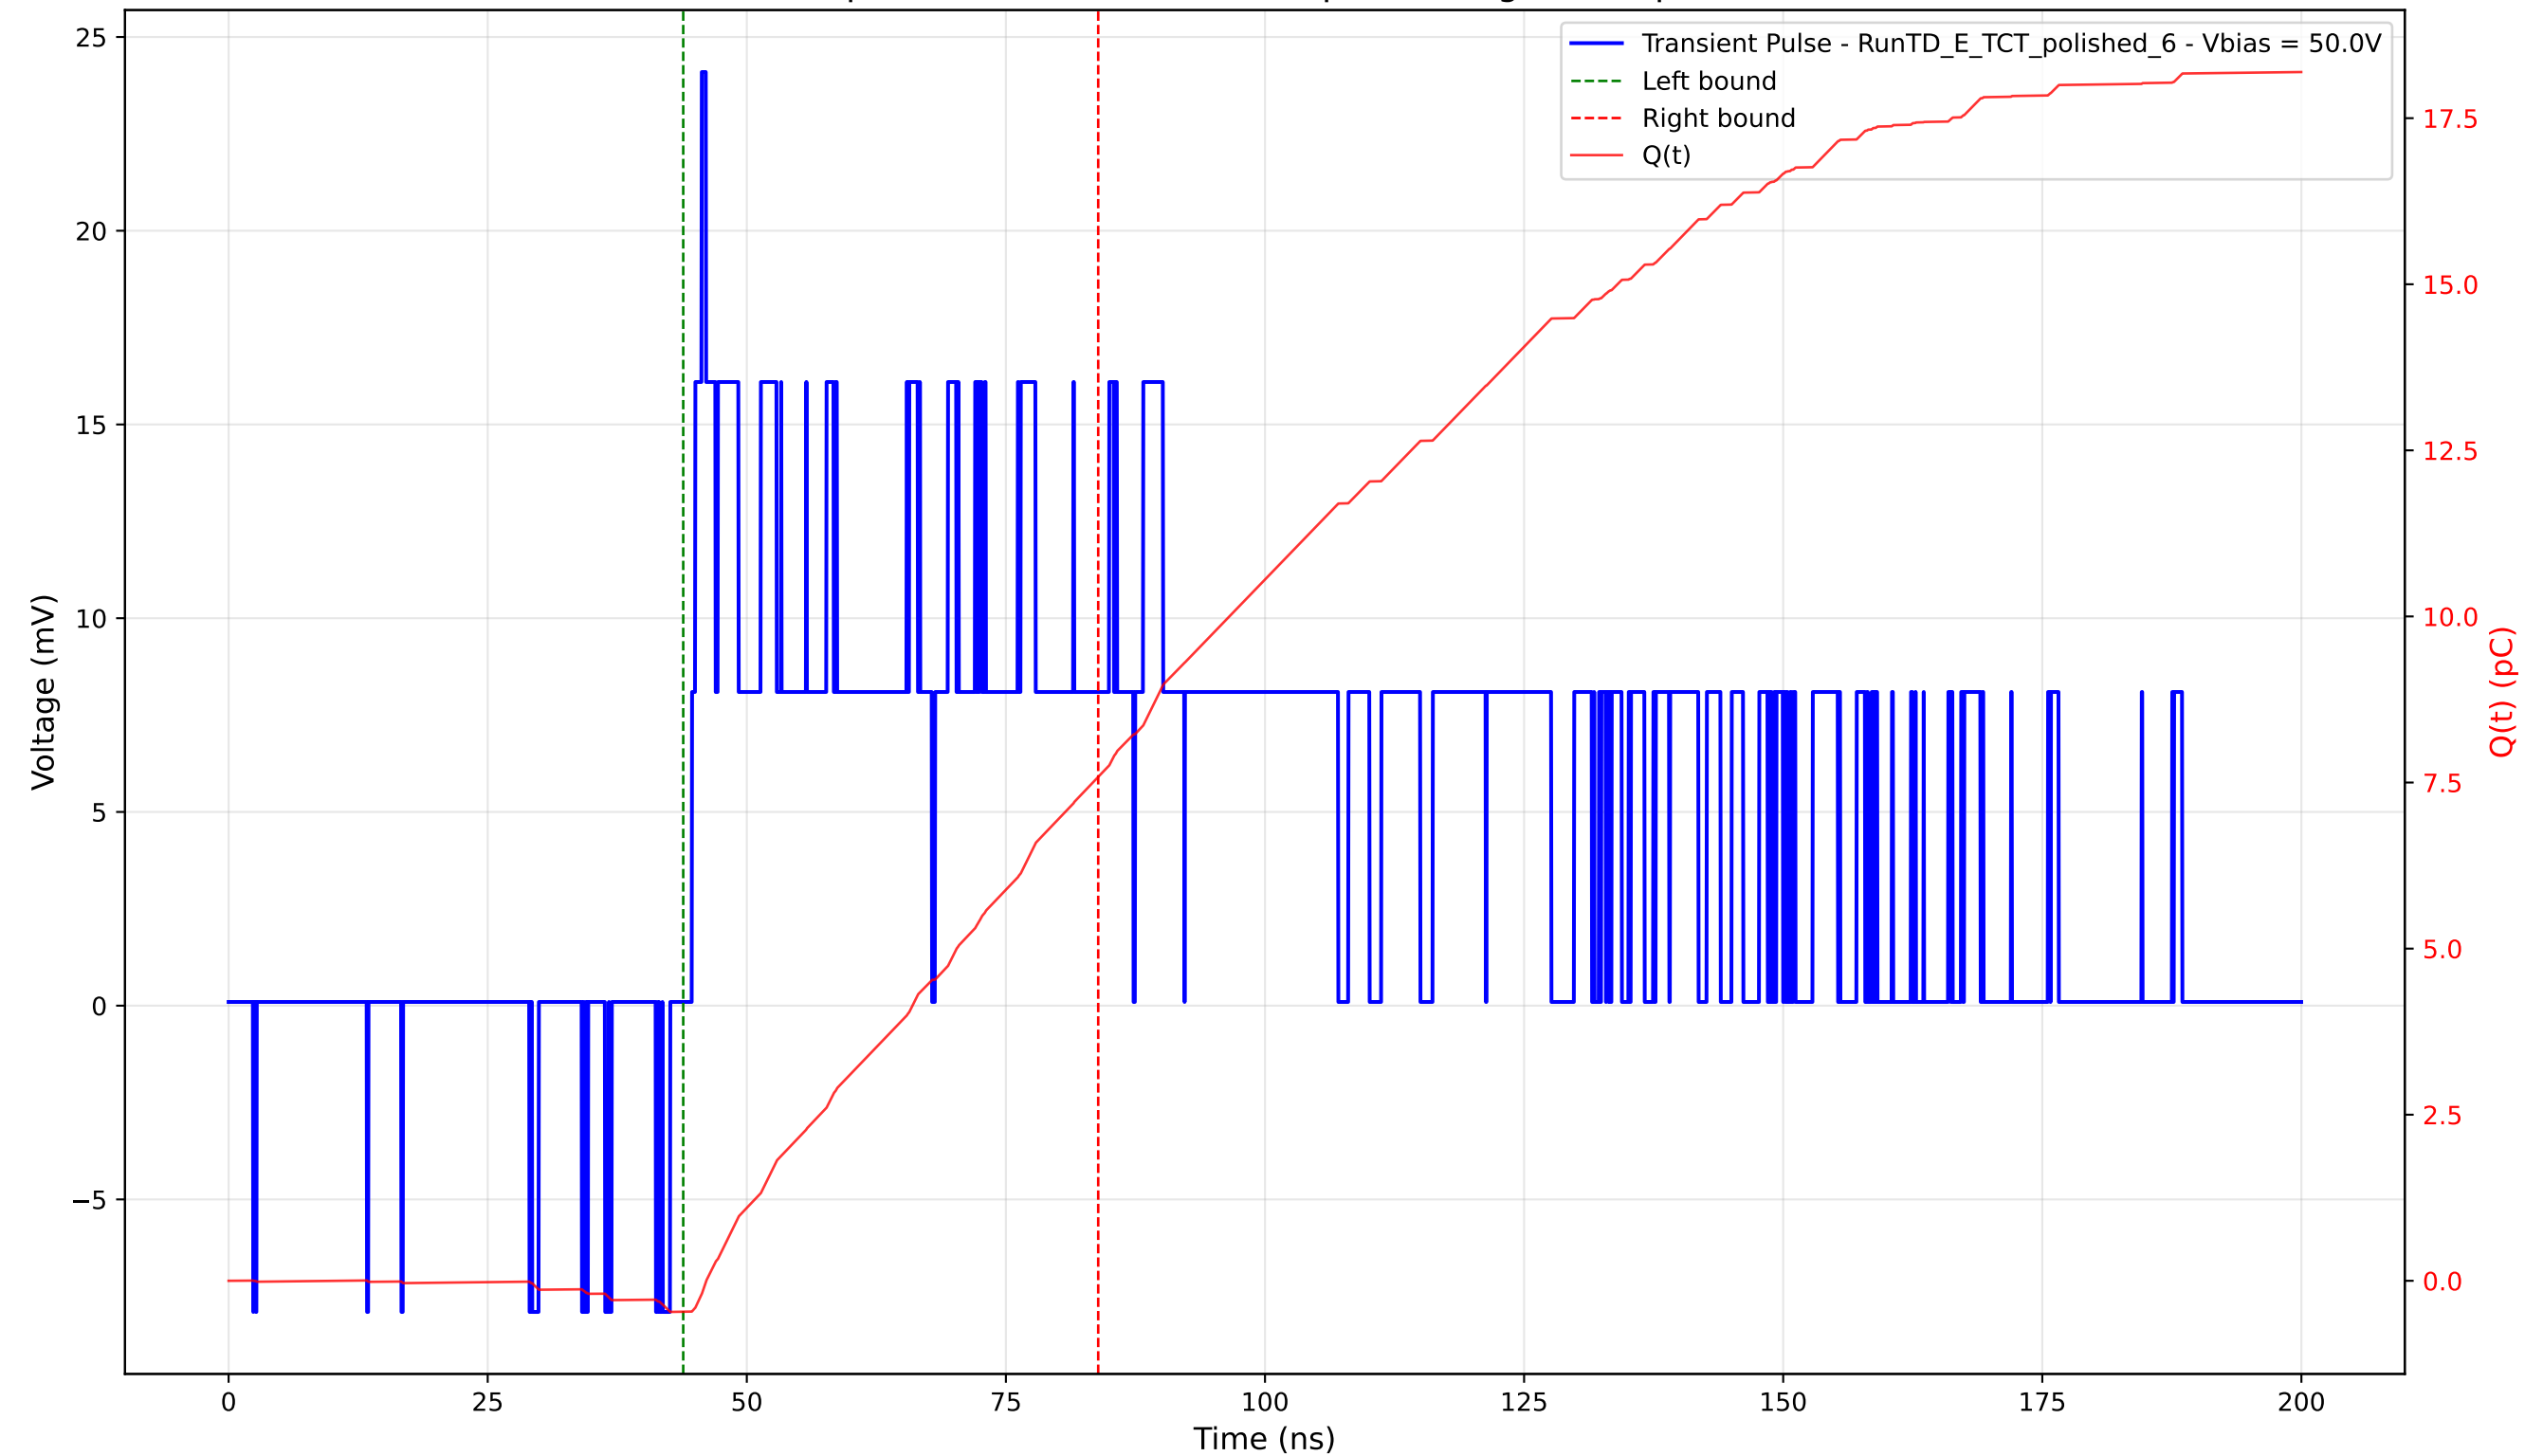


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 5.14 pC - Rise Time: 0.95 ns

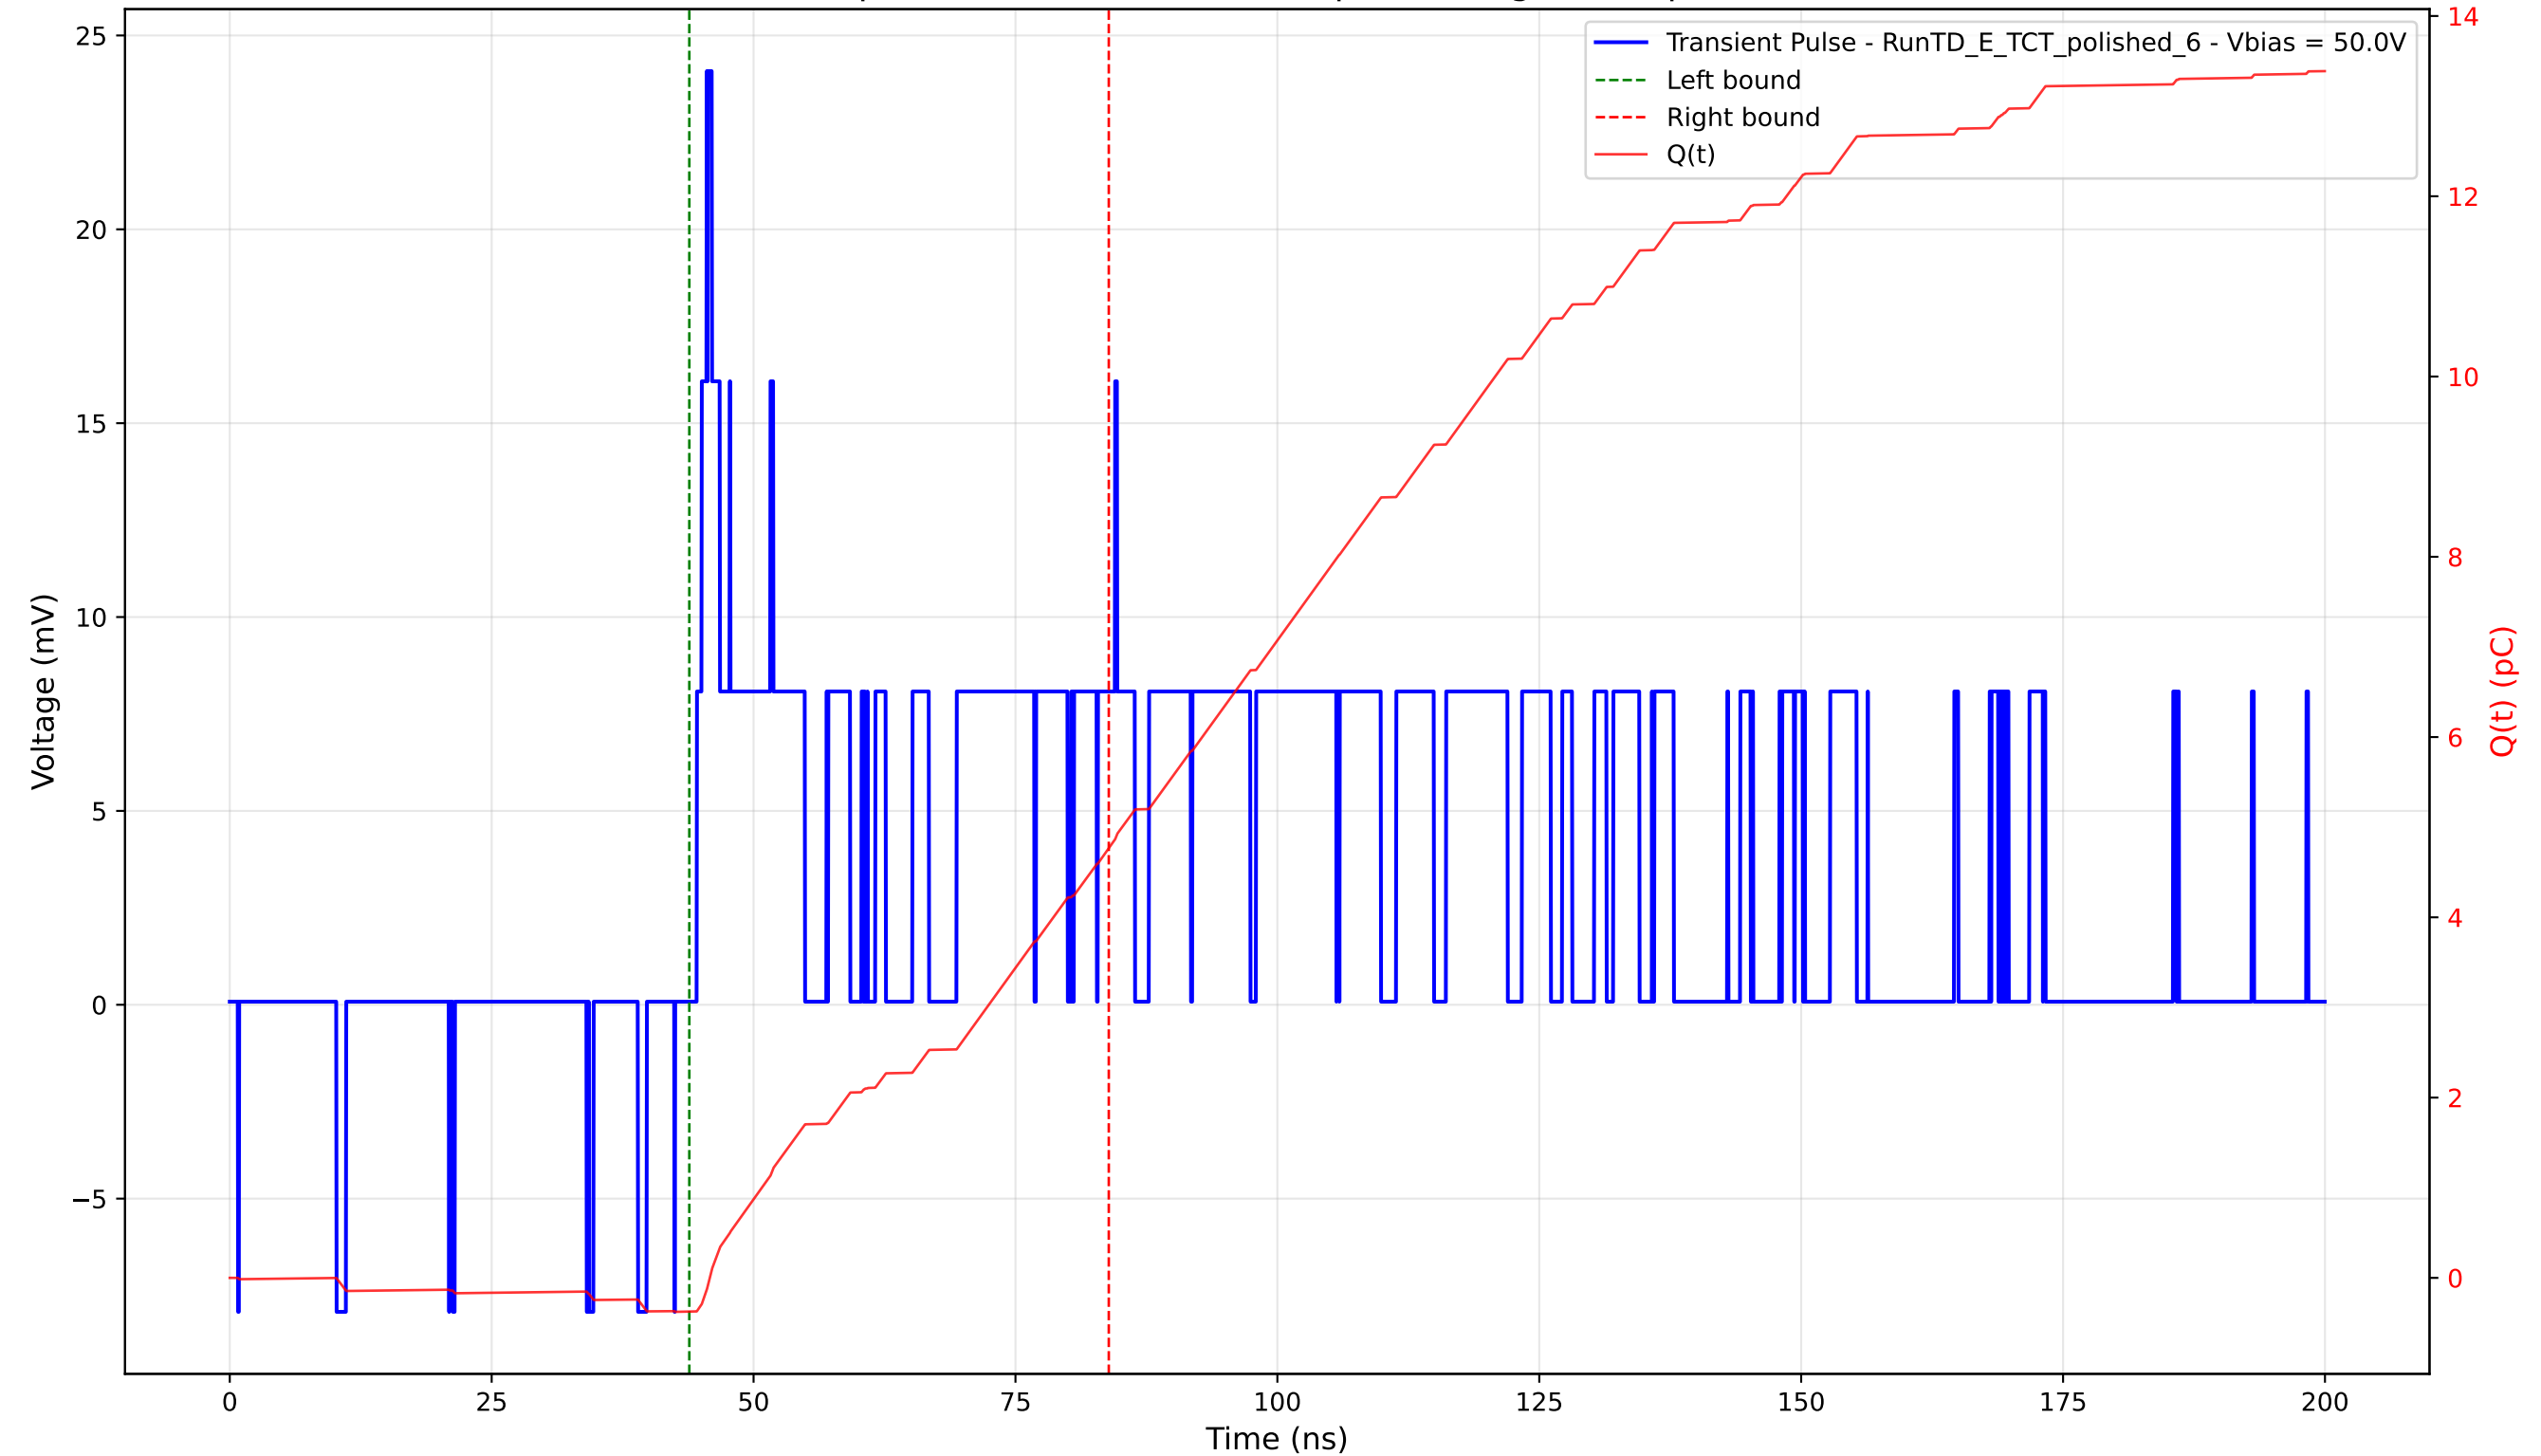


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 5.04 pC - Rise Time: 0.59 ns

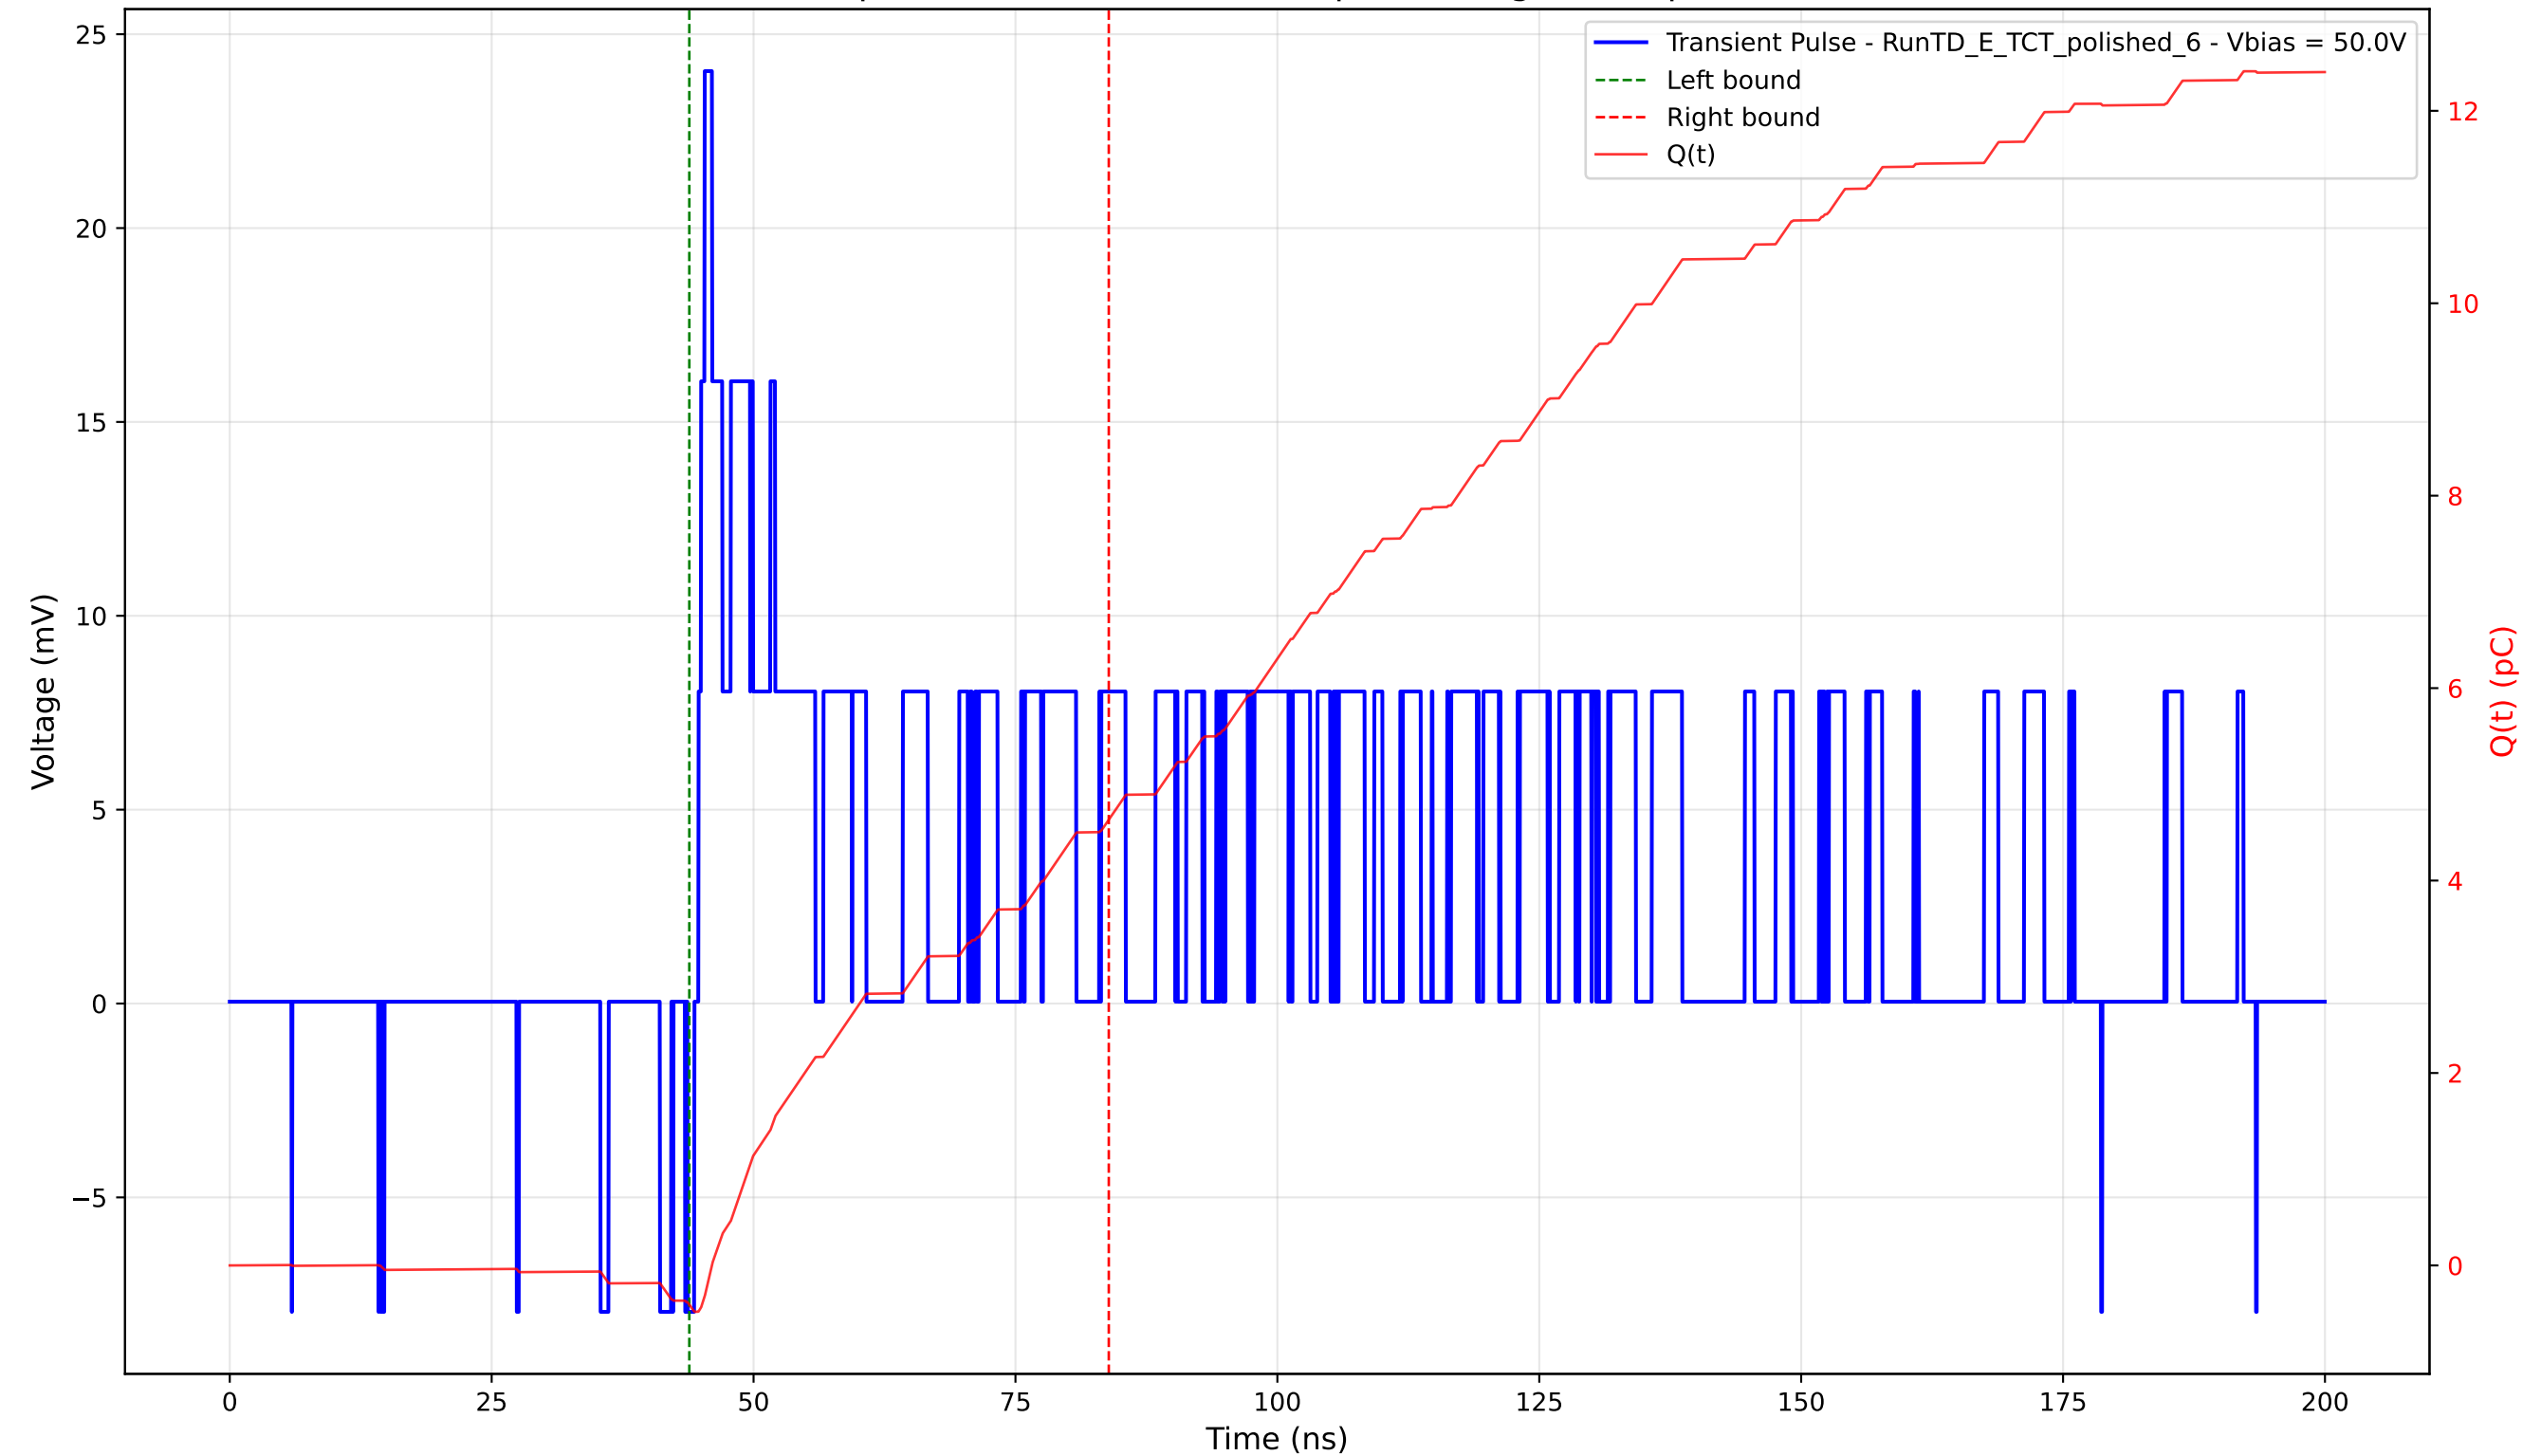


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 1.45 pC - Rise Time: 0.82 ns

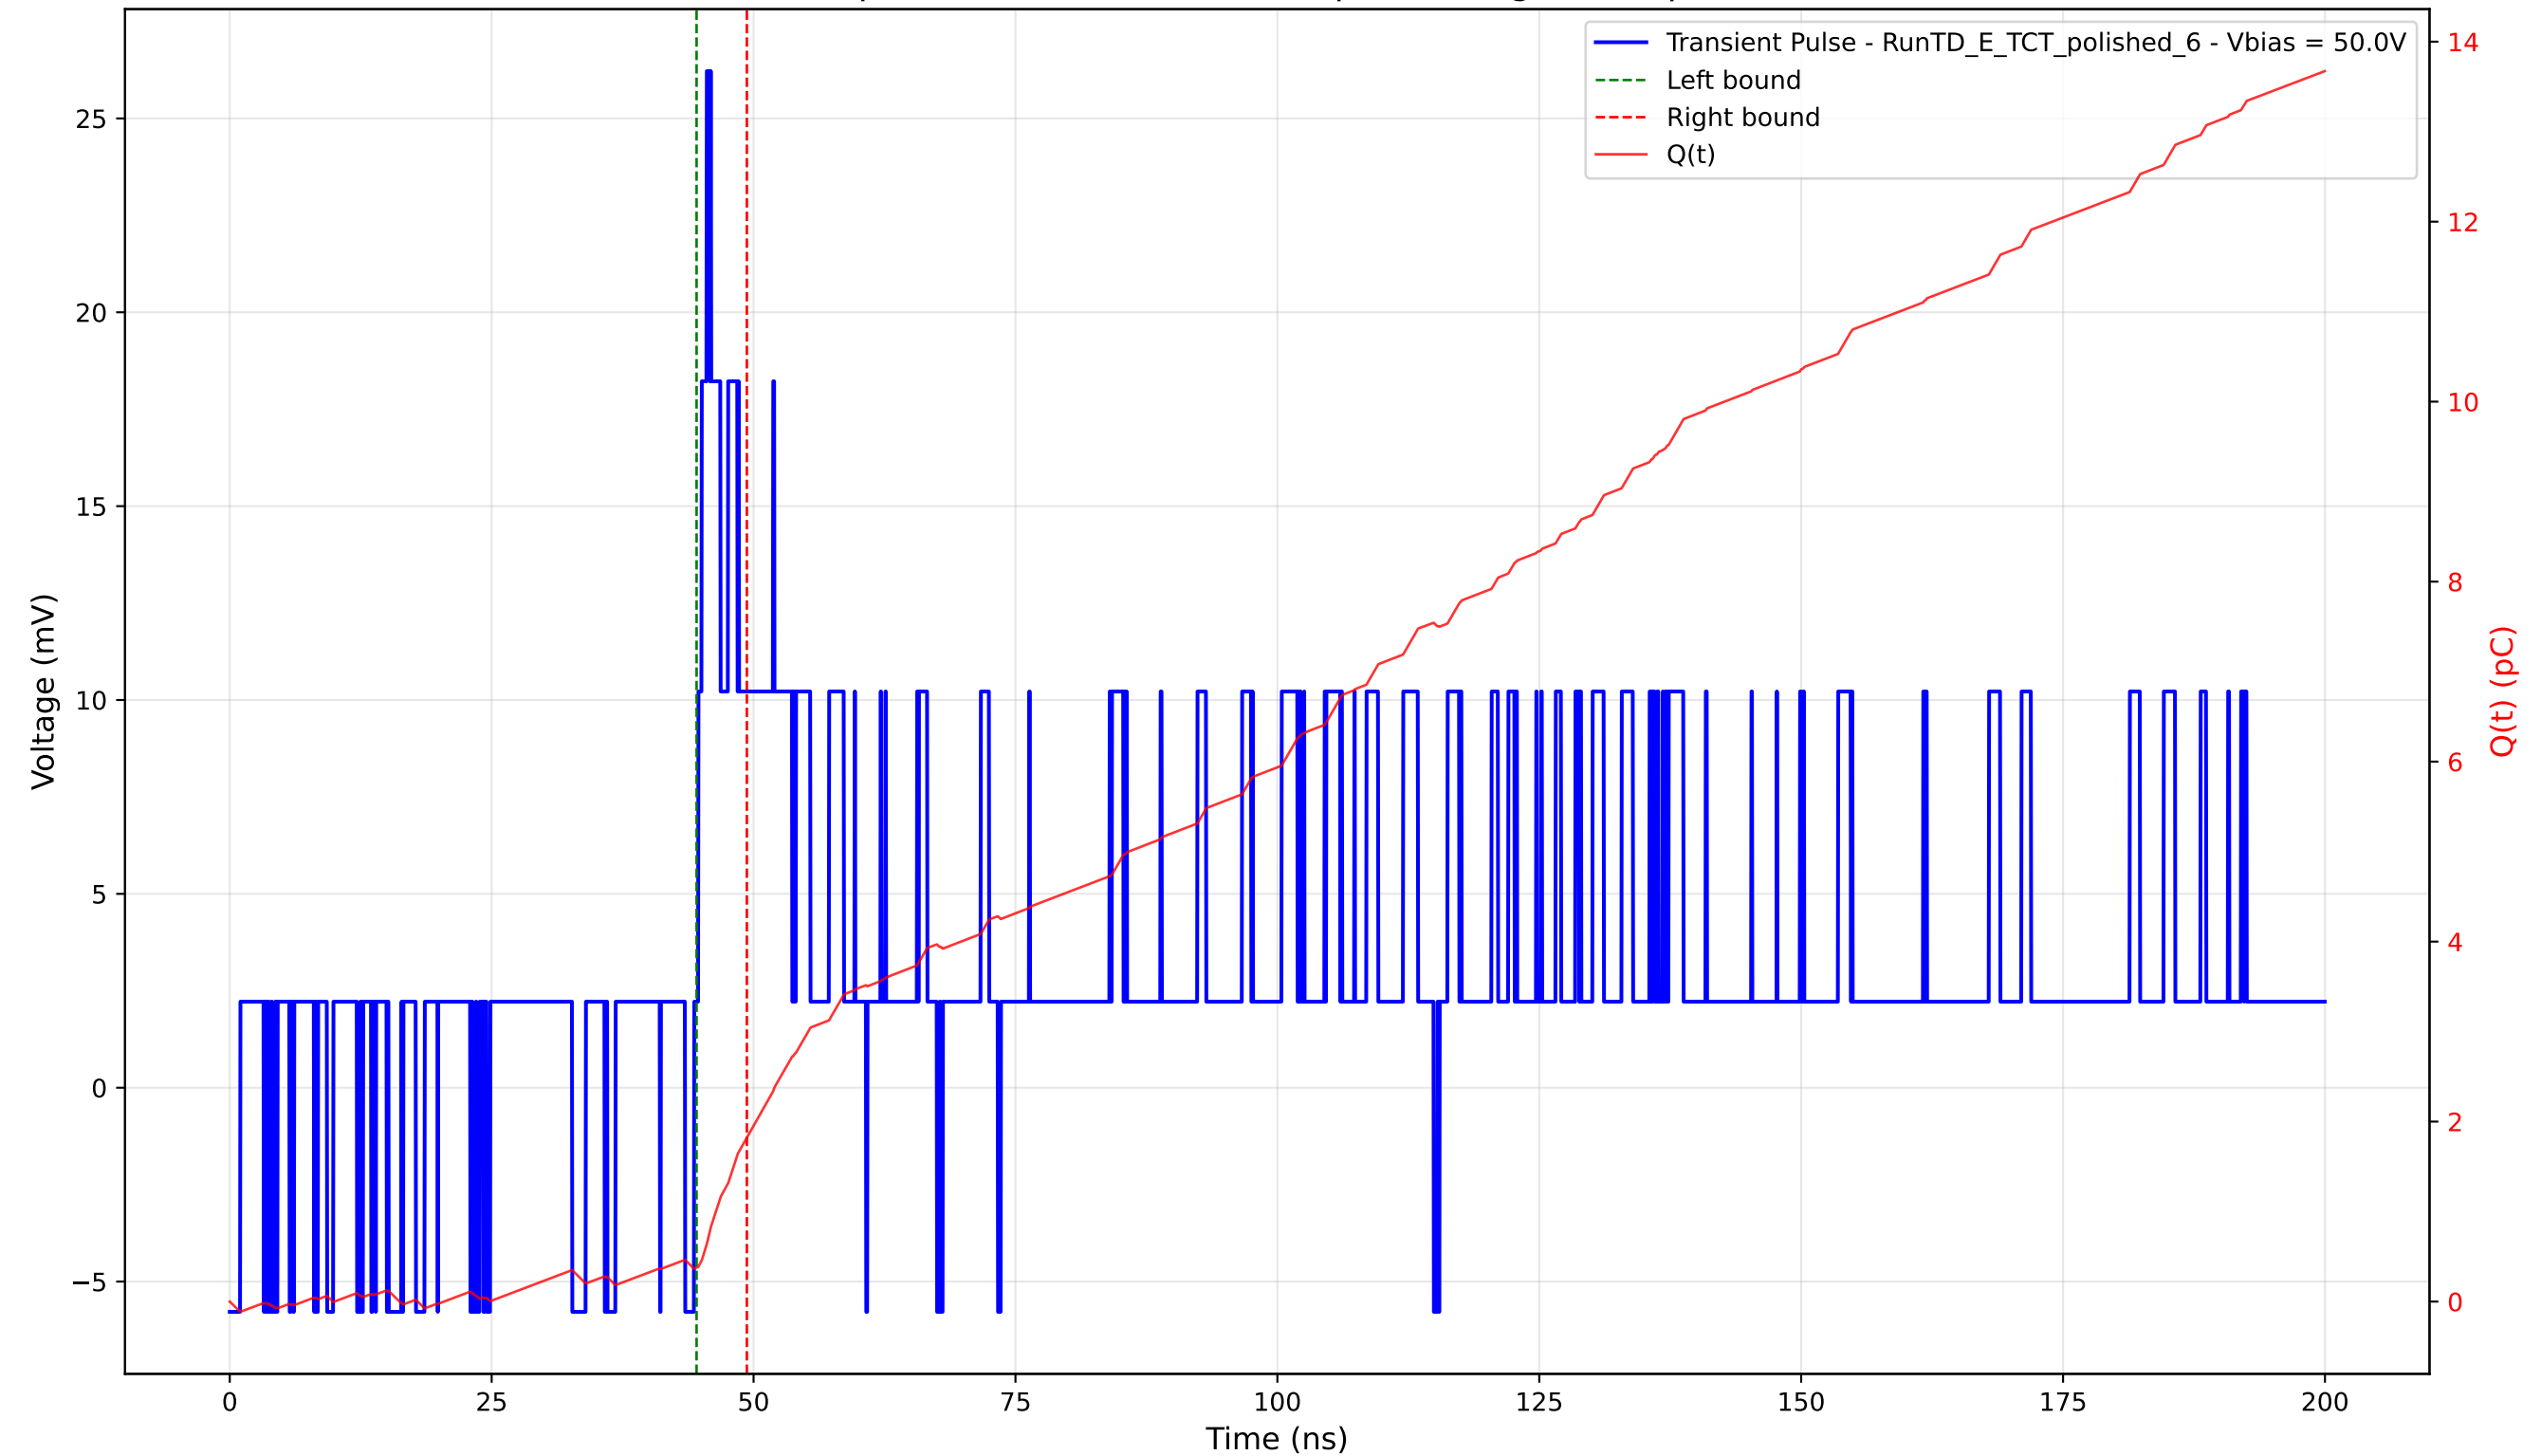


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 3.00 pC - Rise Time: 0.84 ns

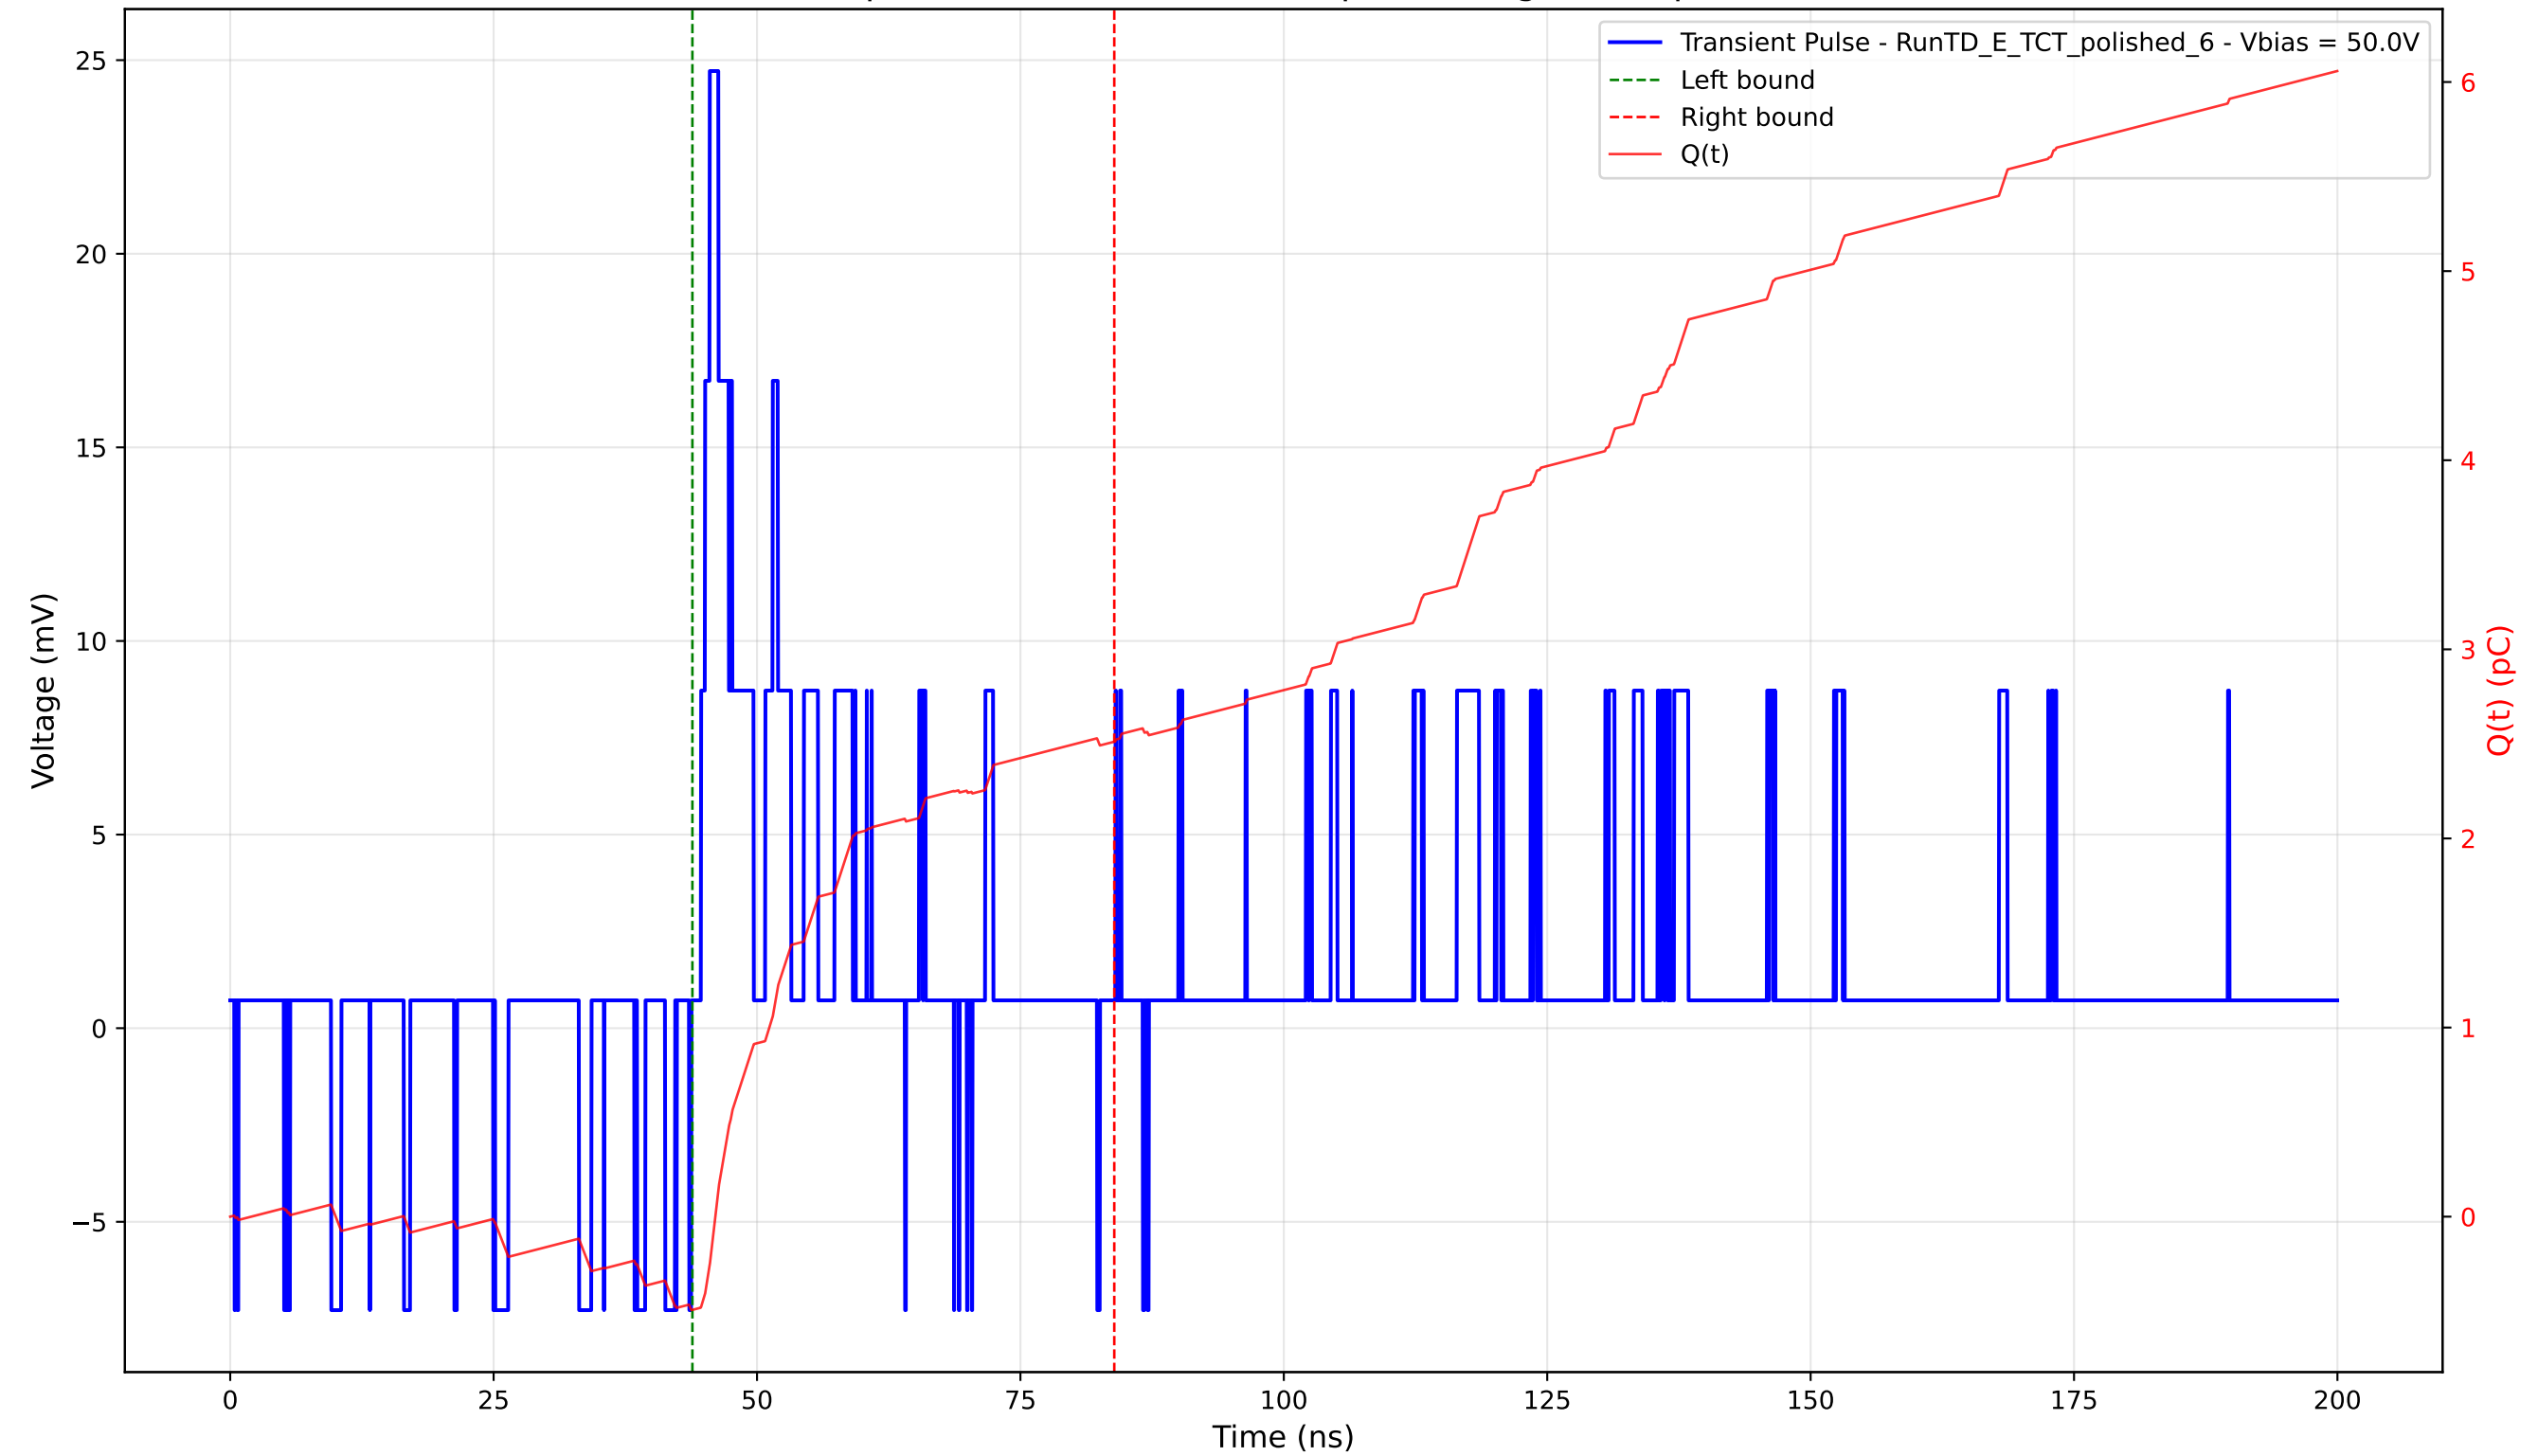


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 3.17 pC - Rise Time: 0.46 ns

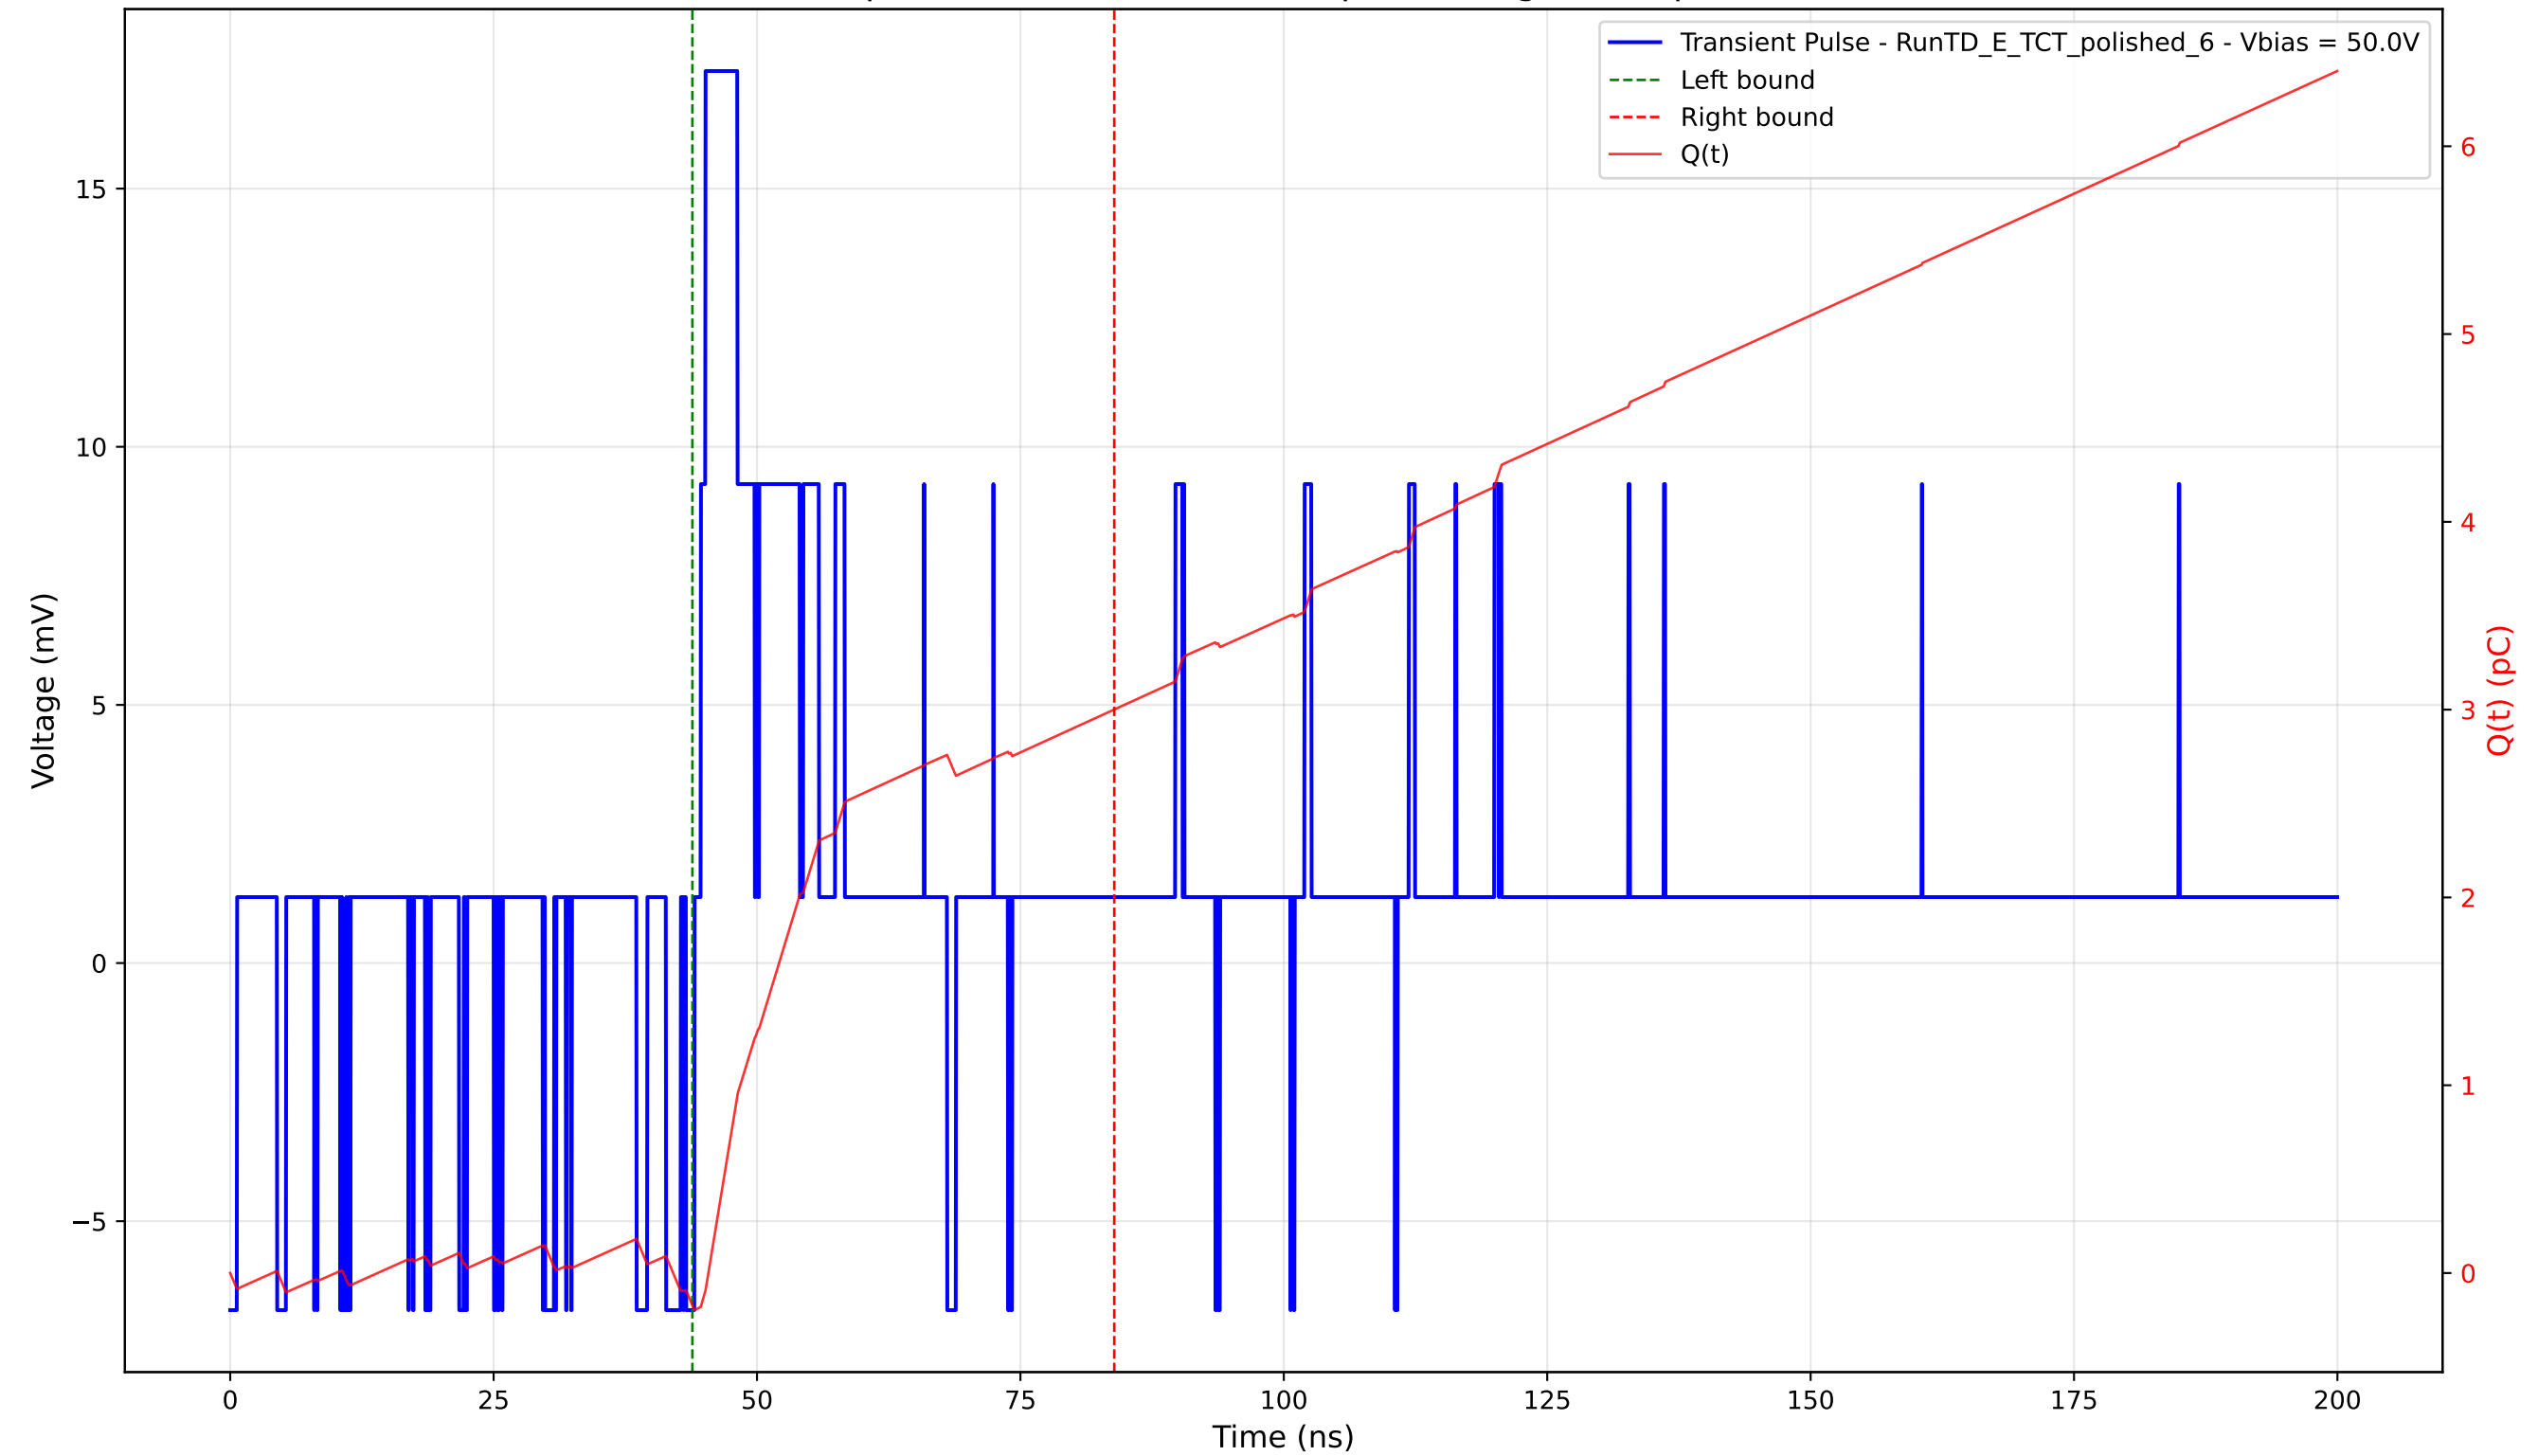


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 4.11 pC - Rise Time: 0.00 ns (N/A)

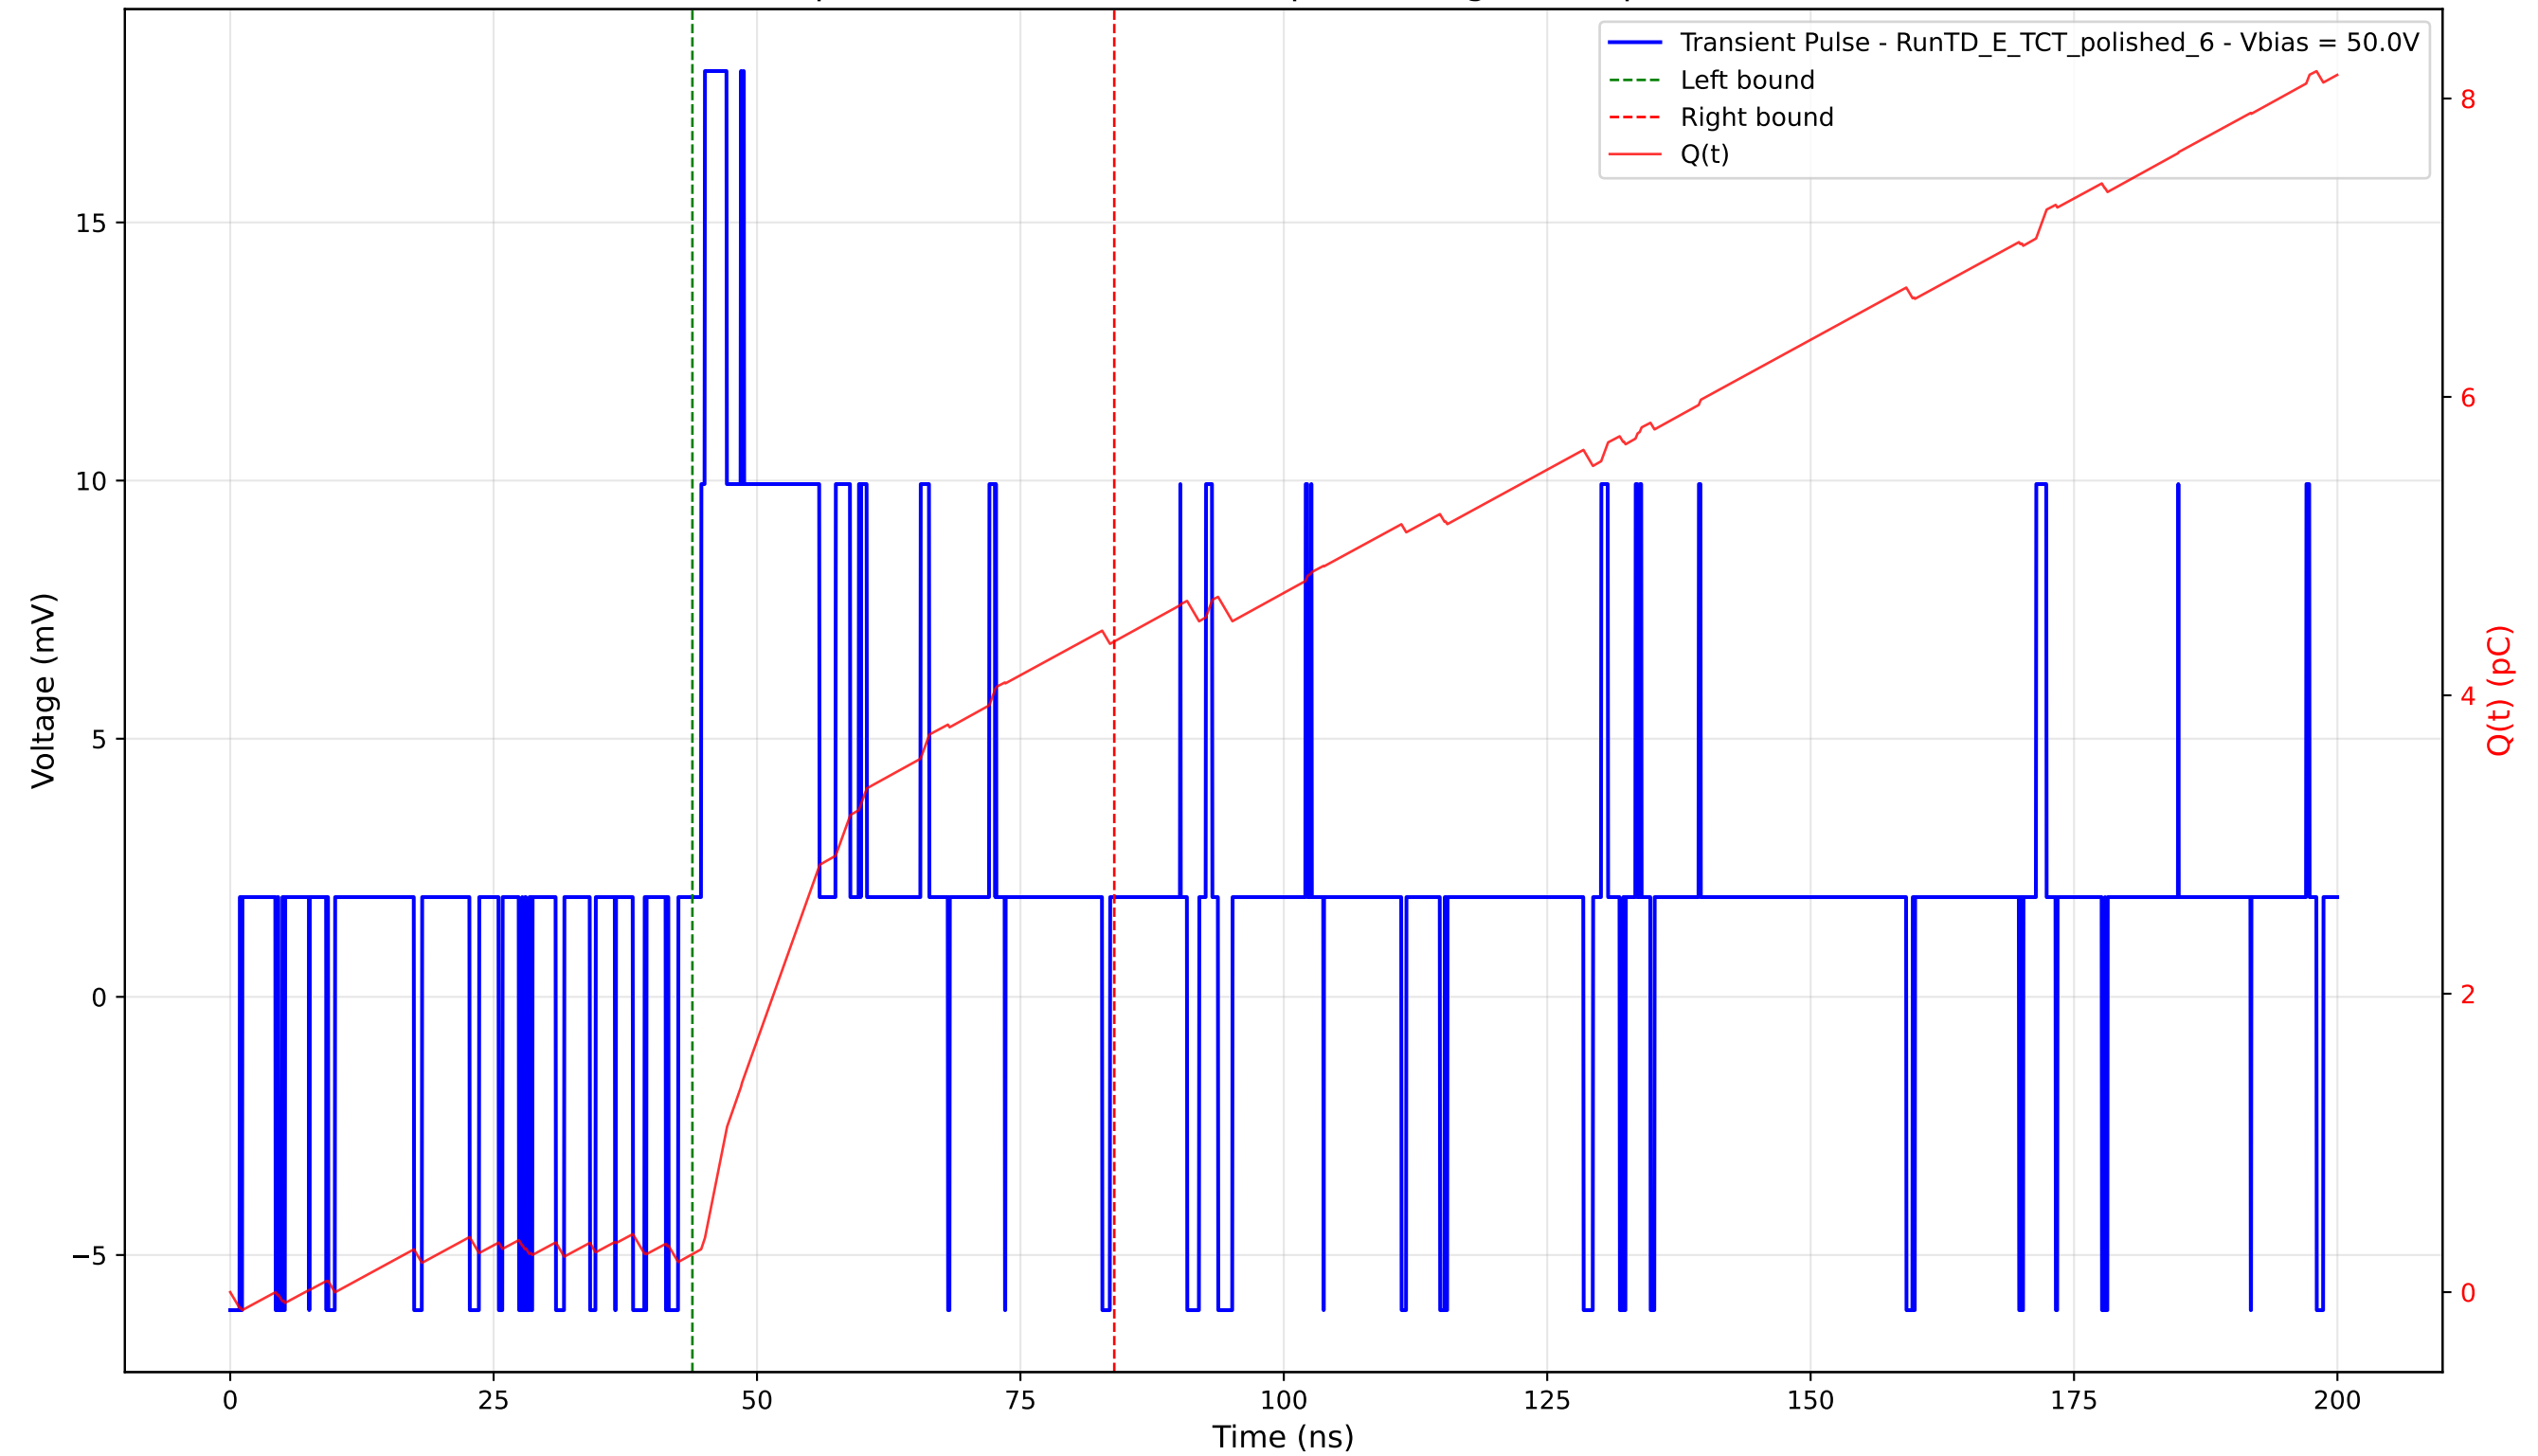


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 1.55 pC - Rise Time: 0.86 ns

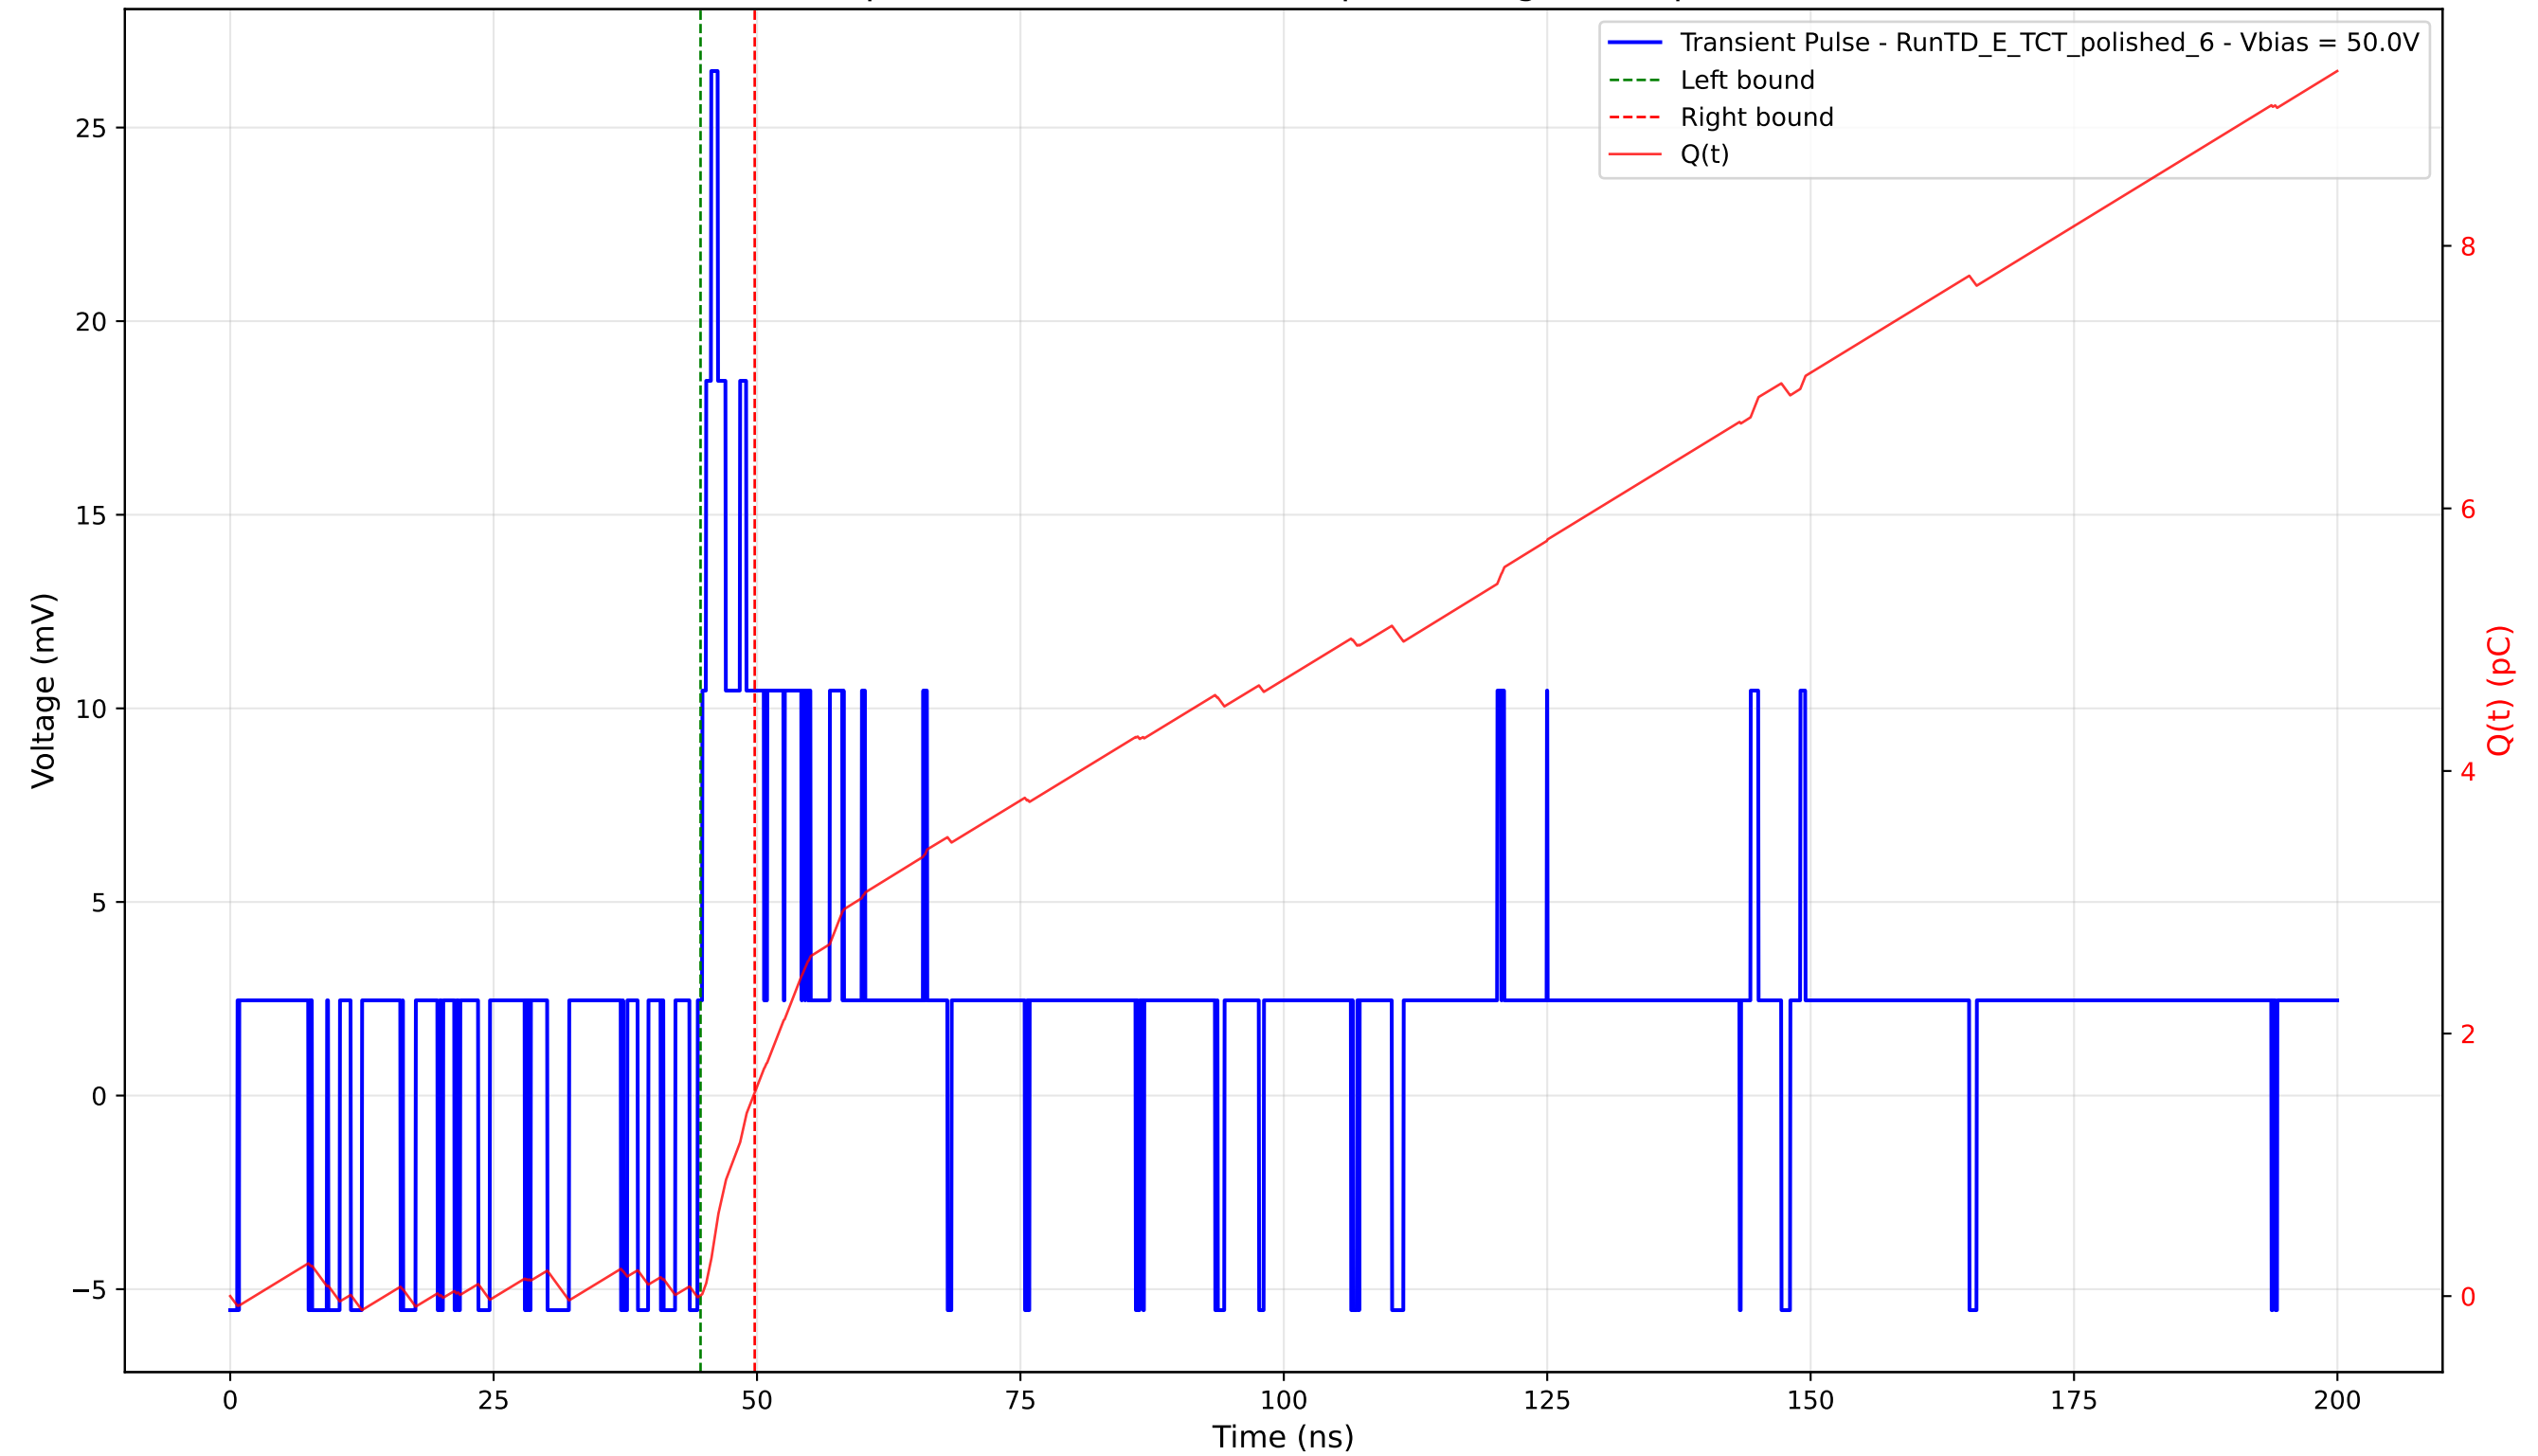


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 2.75 pC - Rise Time: 0.80 ns

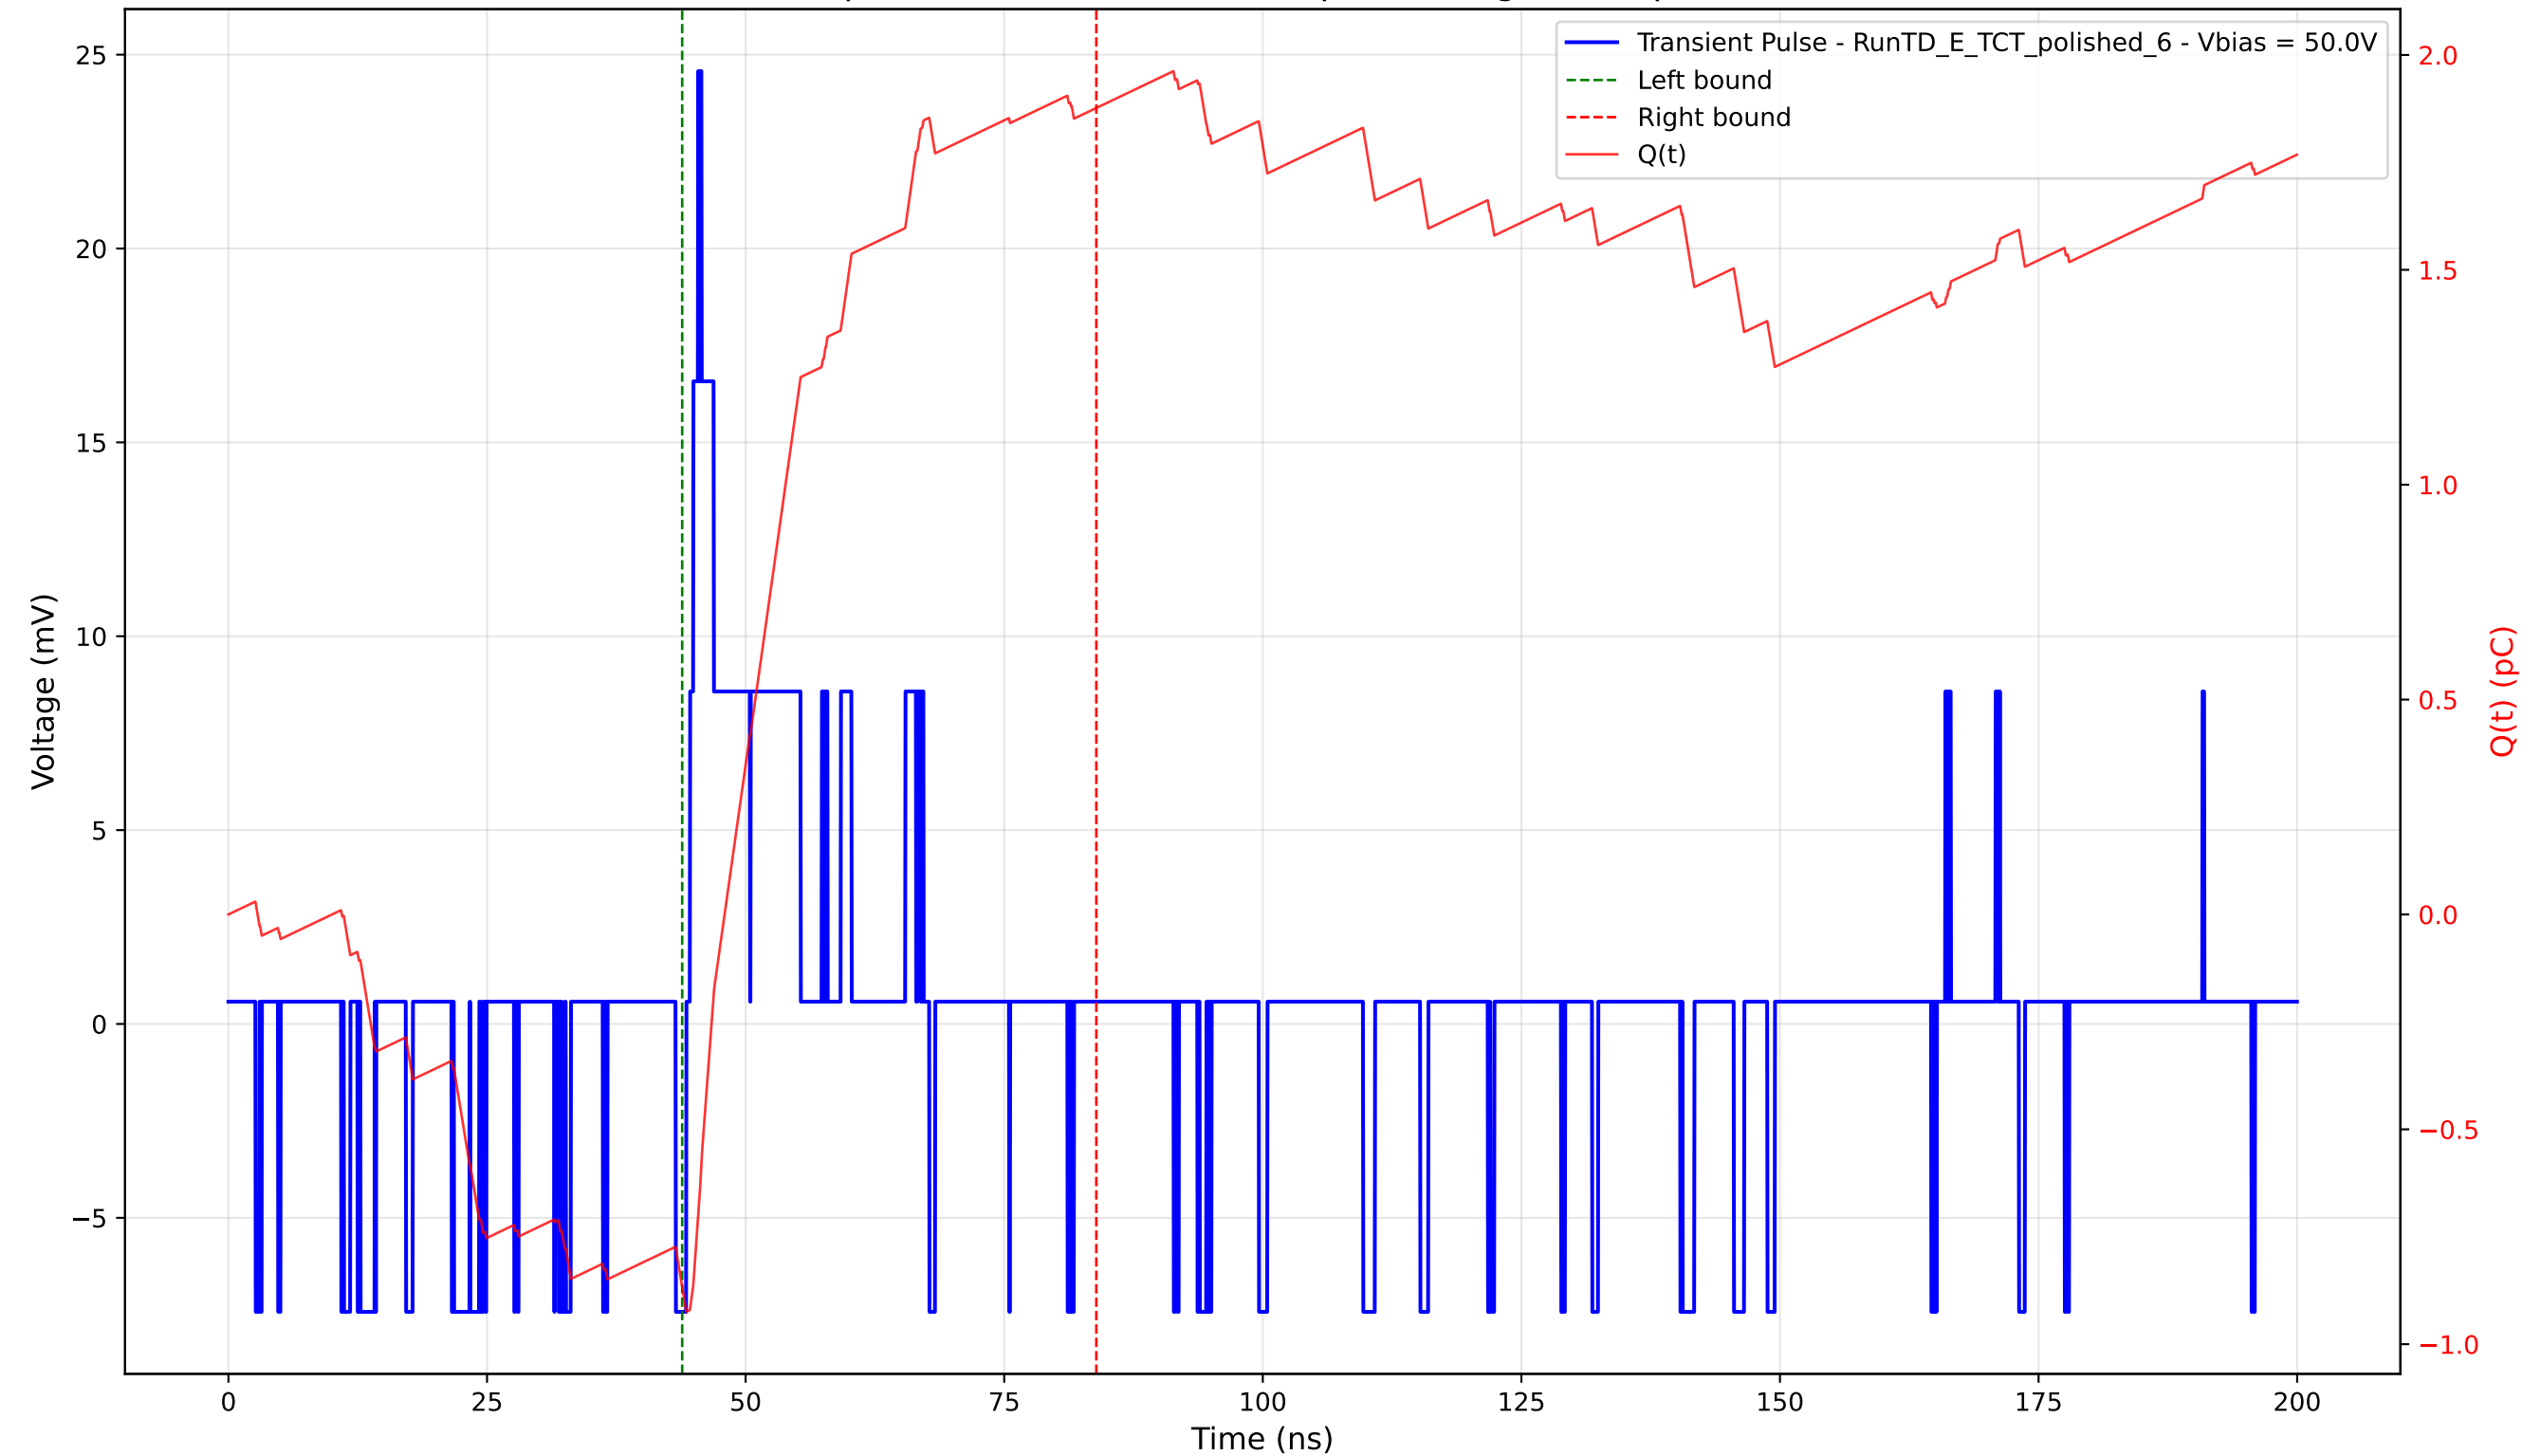


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 2.85 pC - Rise Time: 0.85 ns

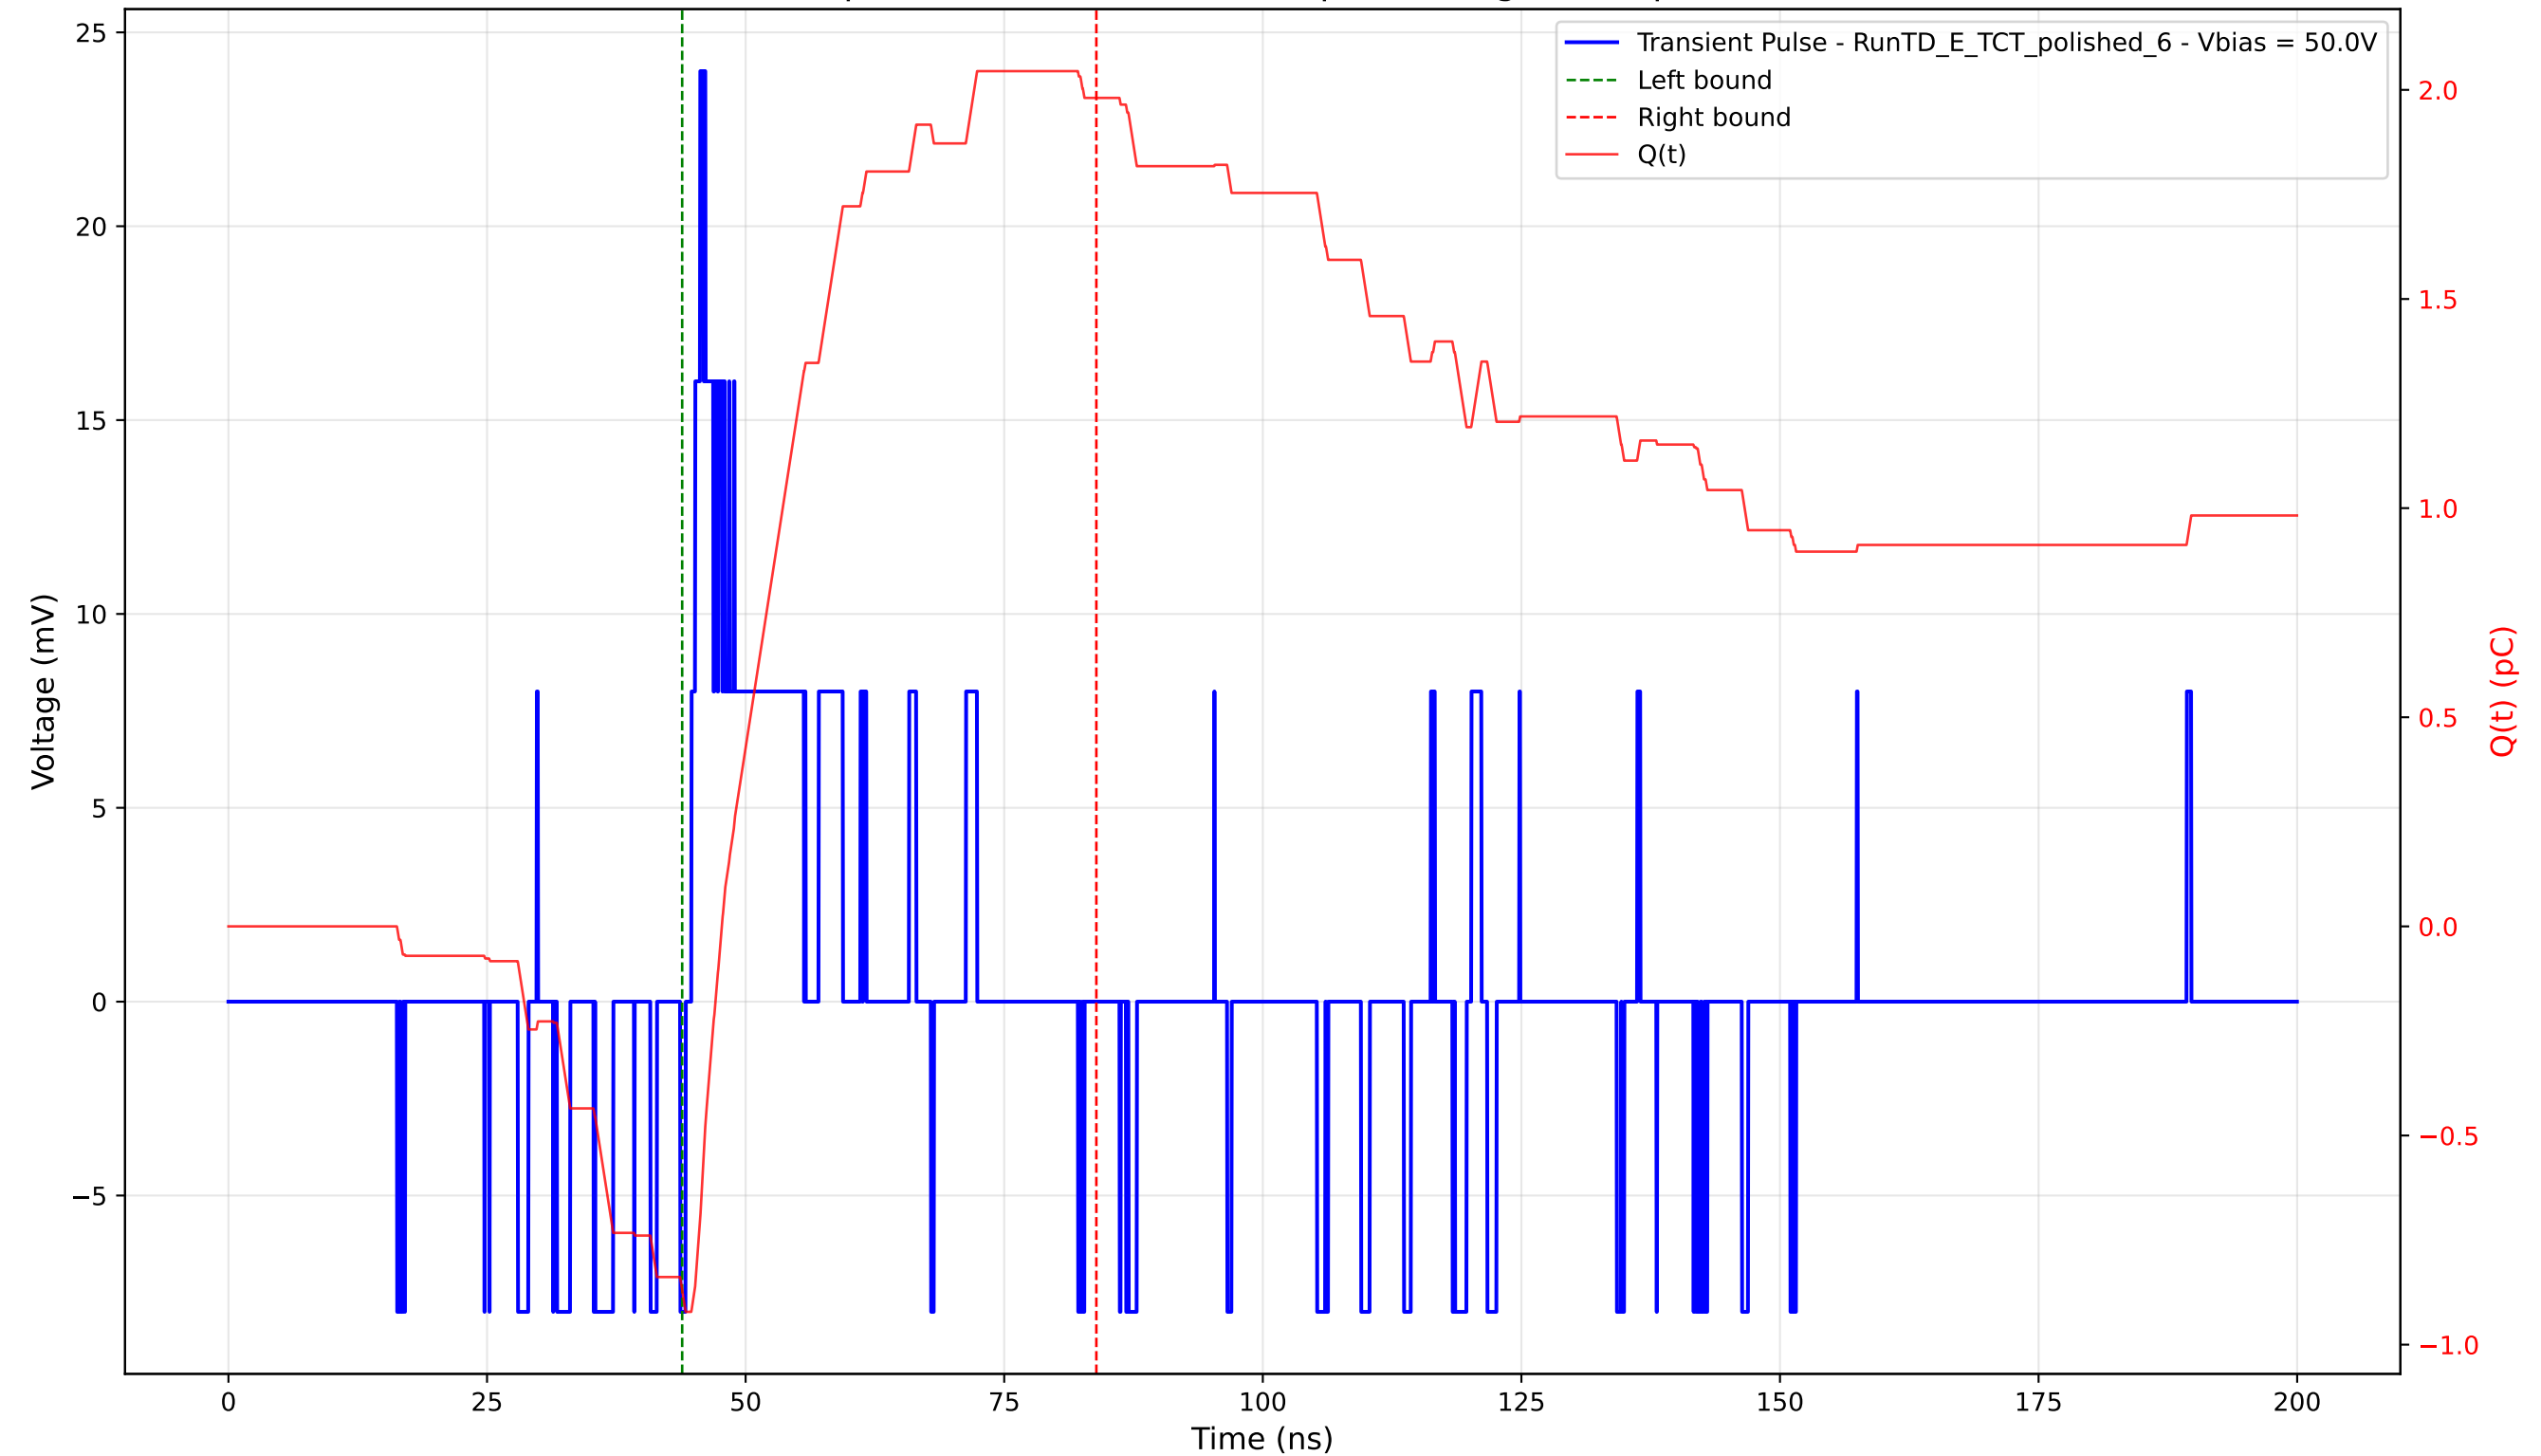


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 1.26 pC - Rise Time: 0.78 ns

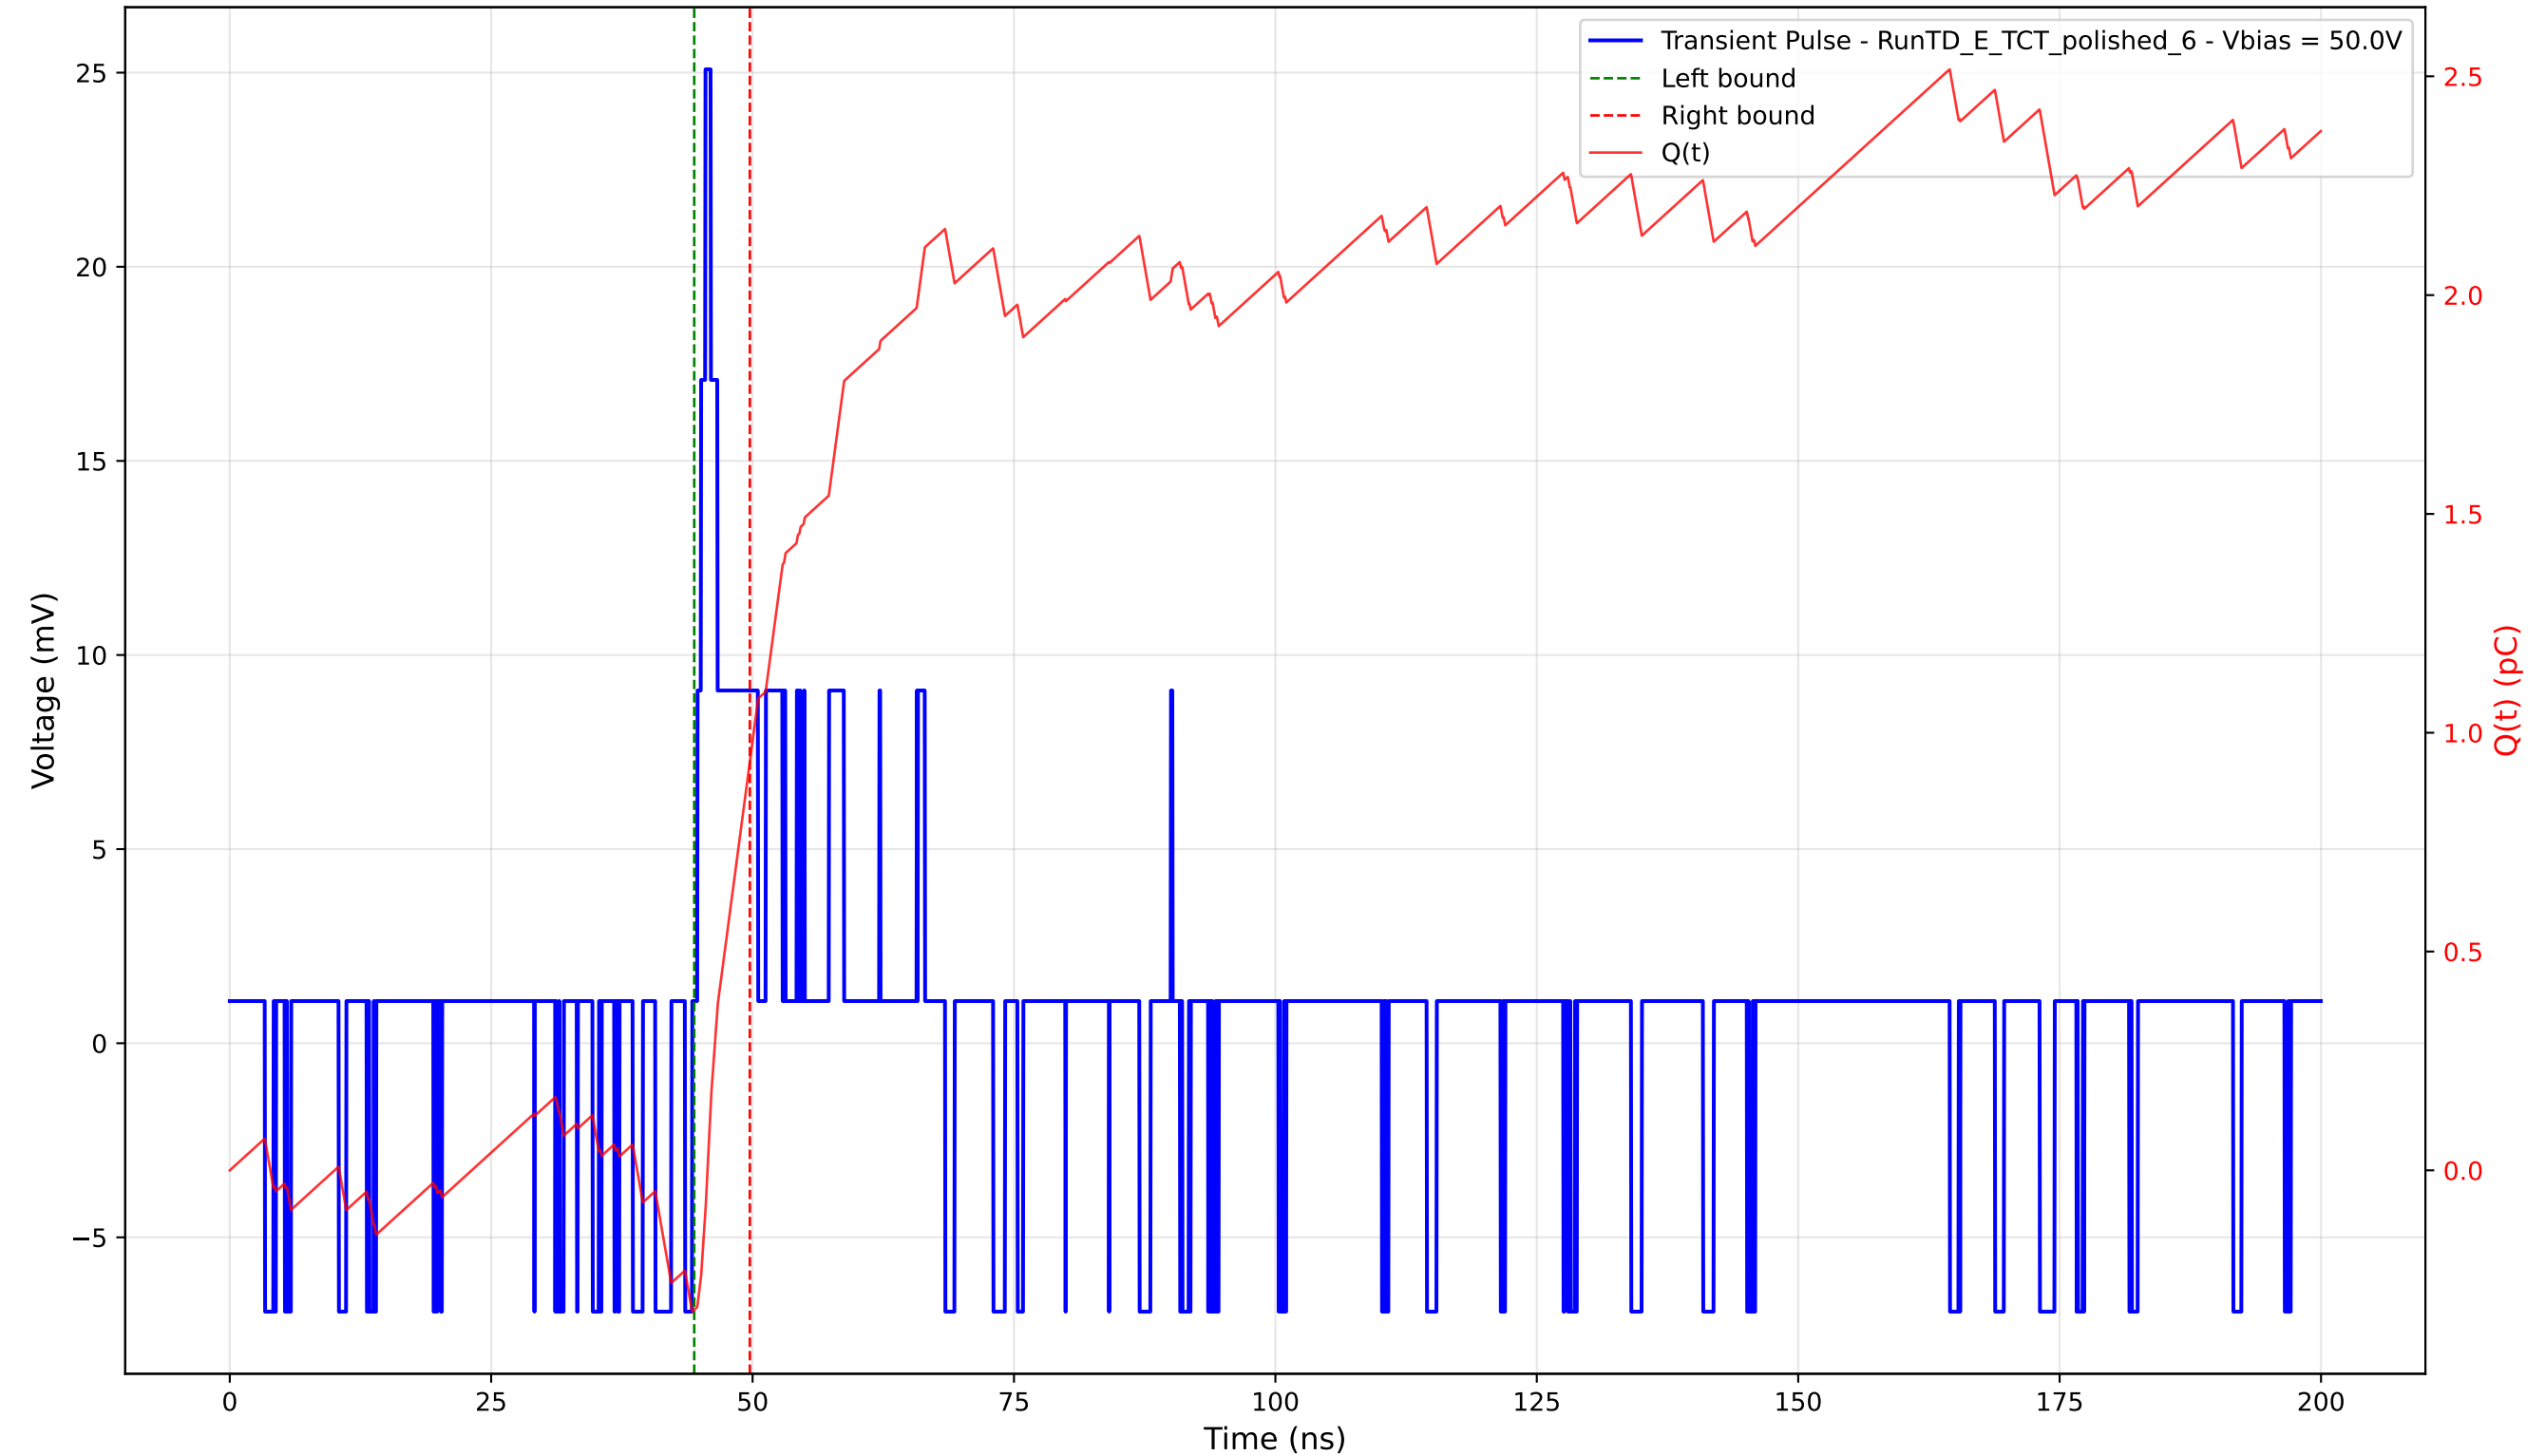


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 3.22 pC - Rise Time: 0.64 ns

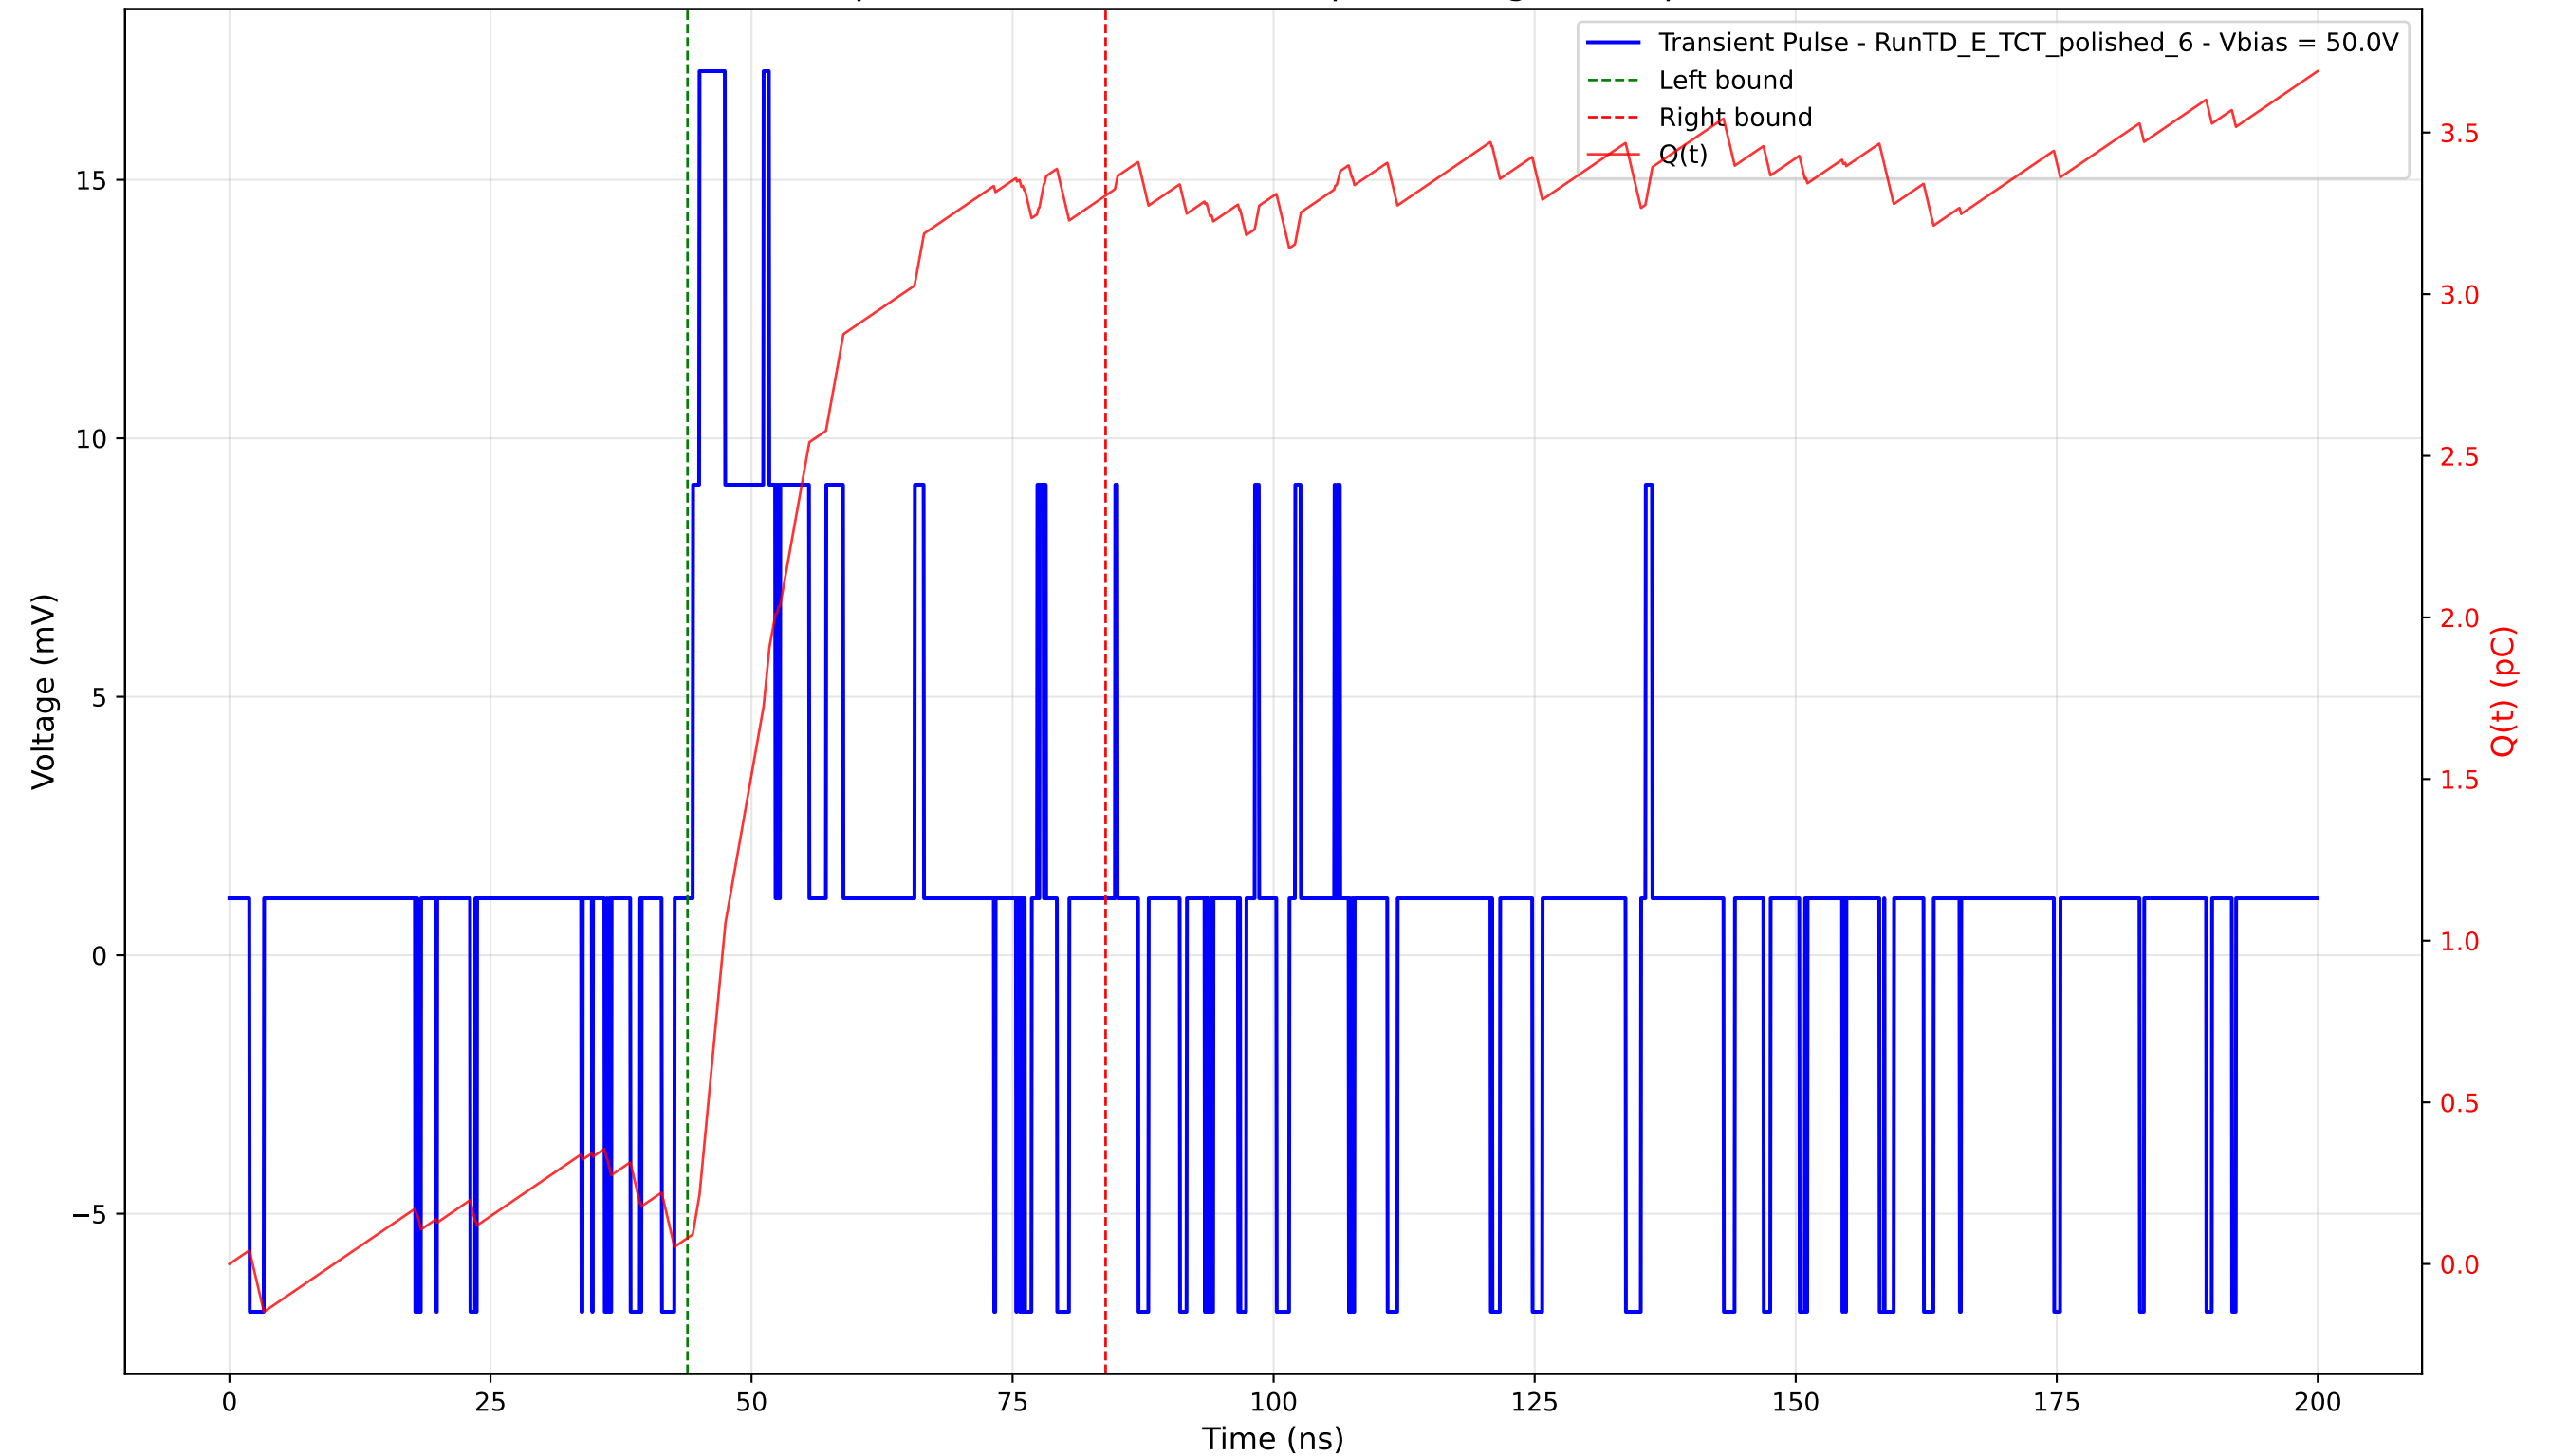


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 1.22 pC - Rise Time: 0.84 ns

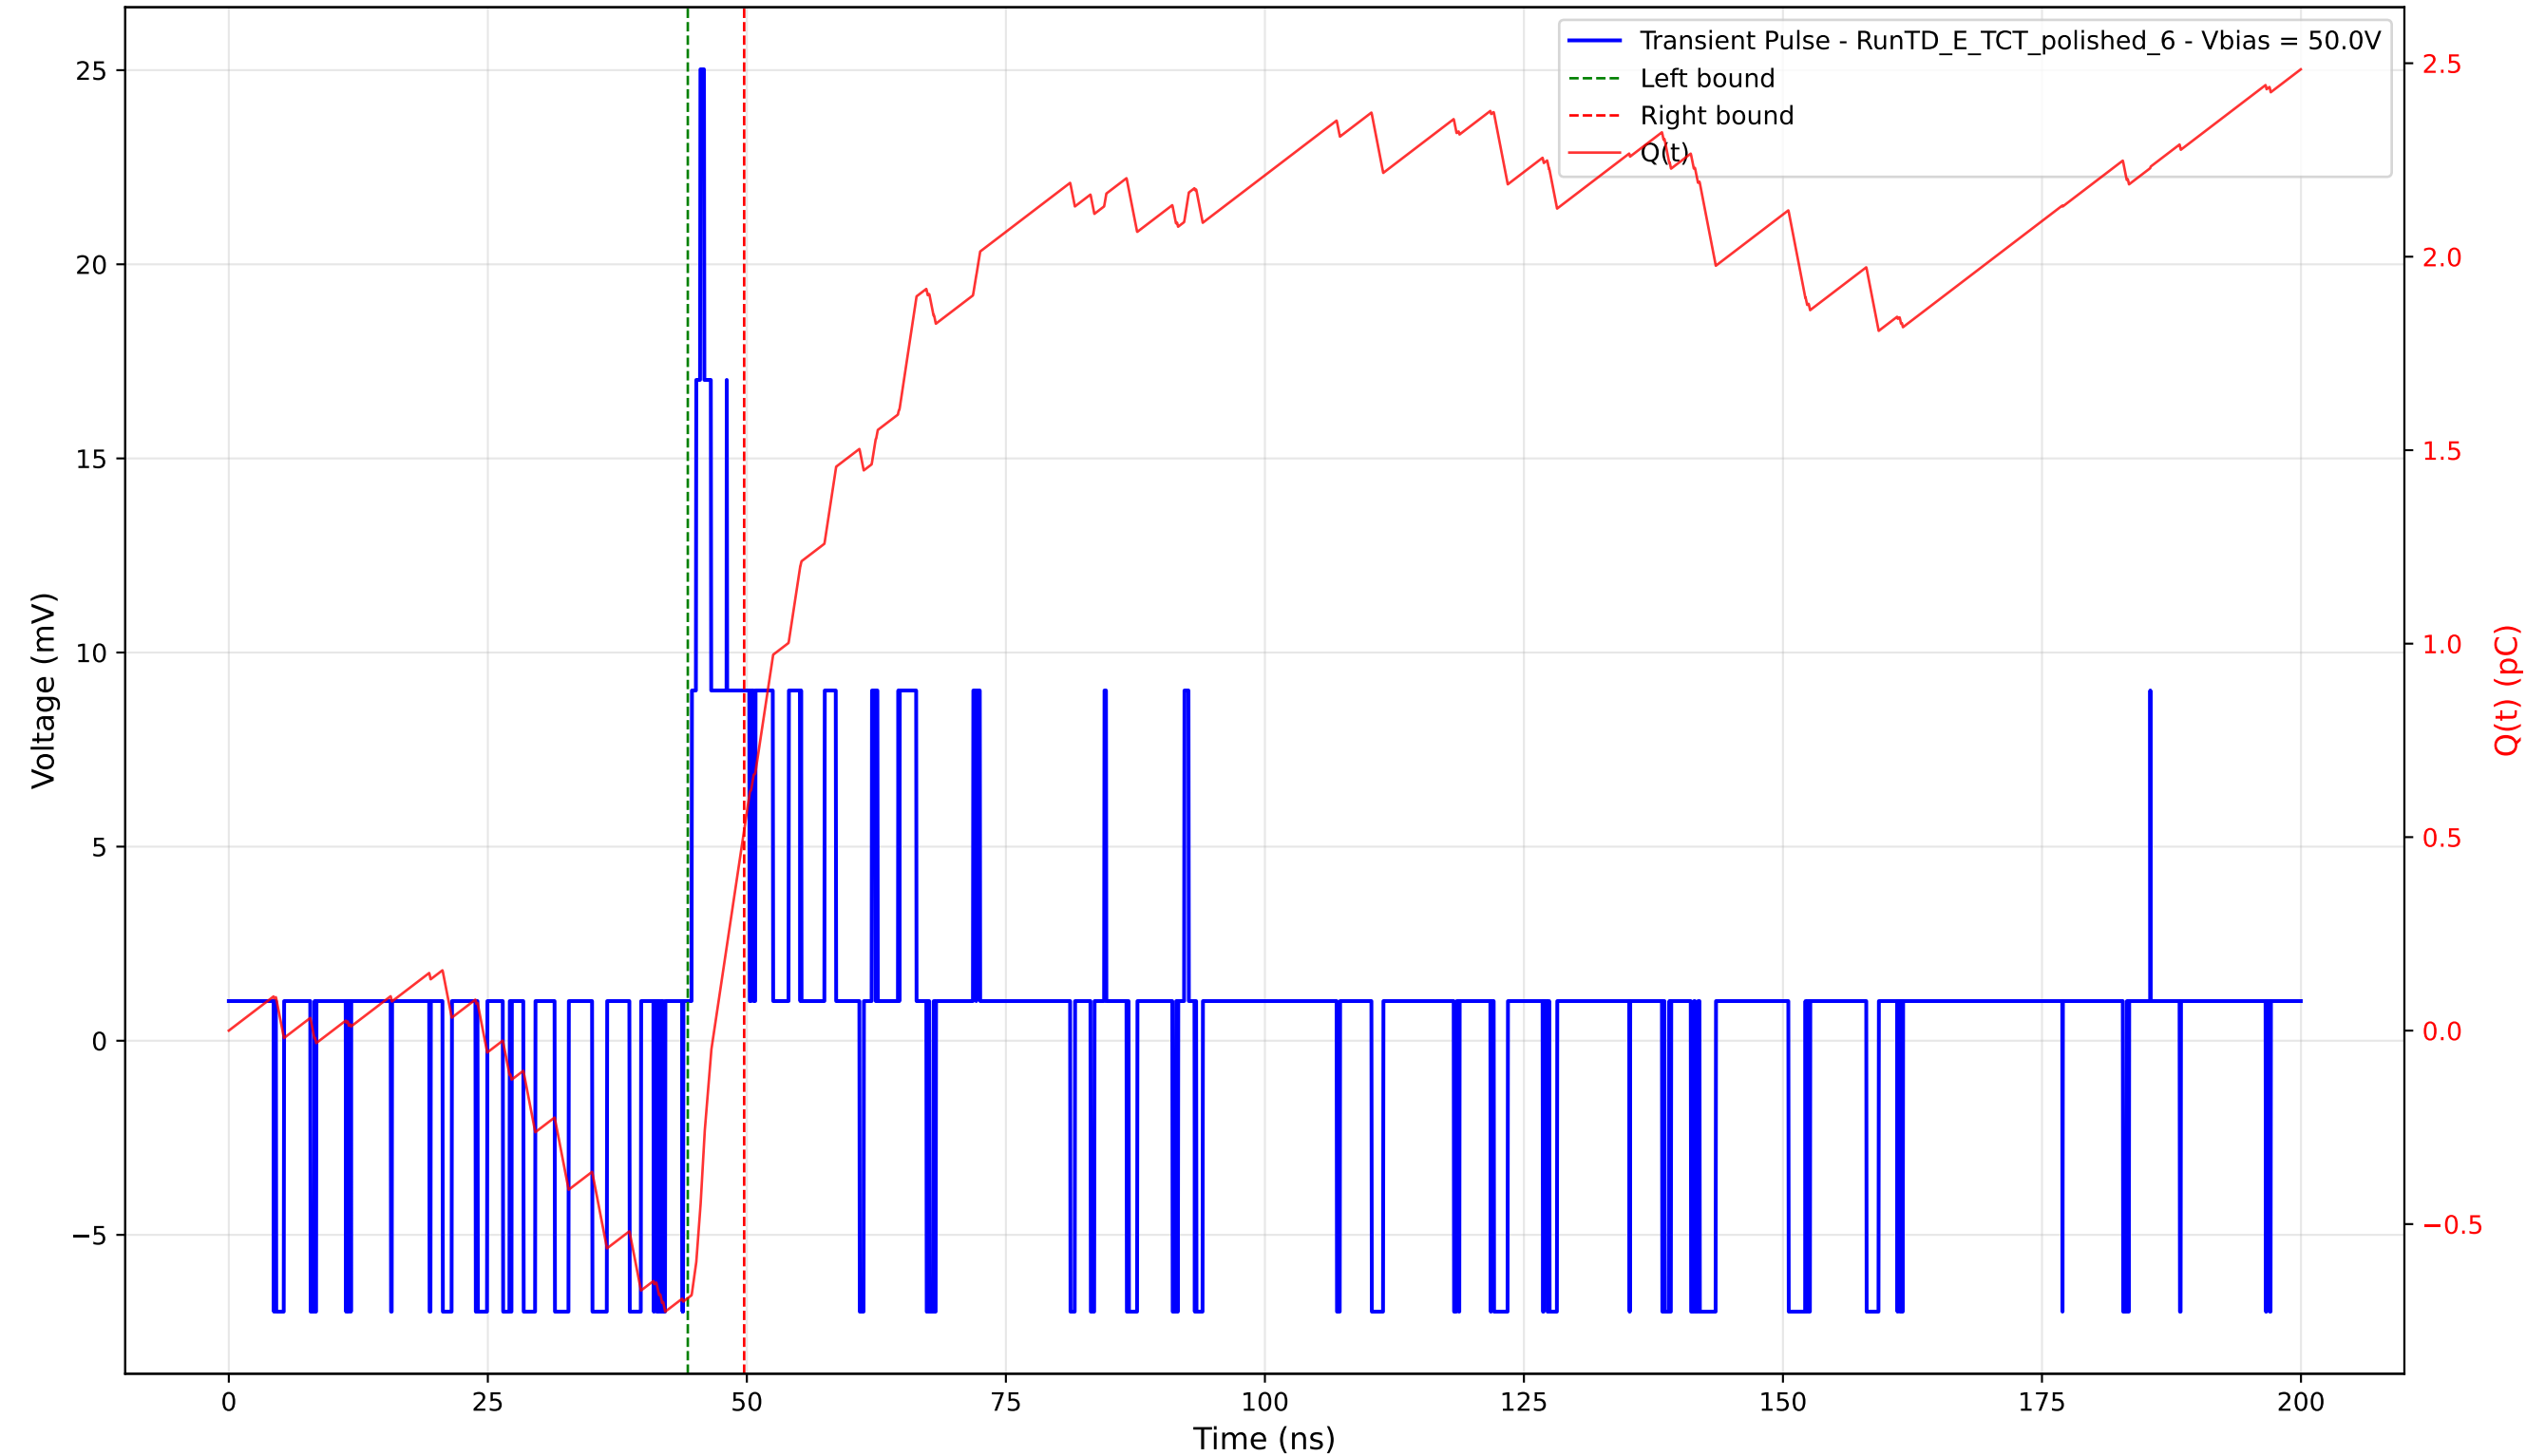


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 1.51 pC - Rise Time: 0.60 ns

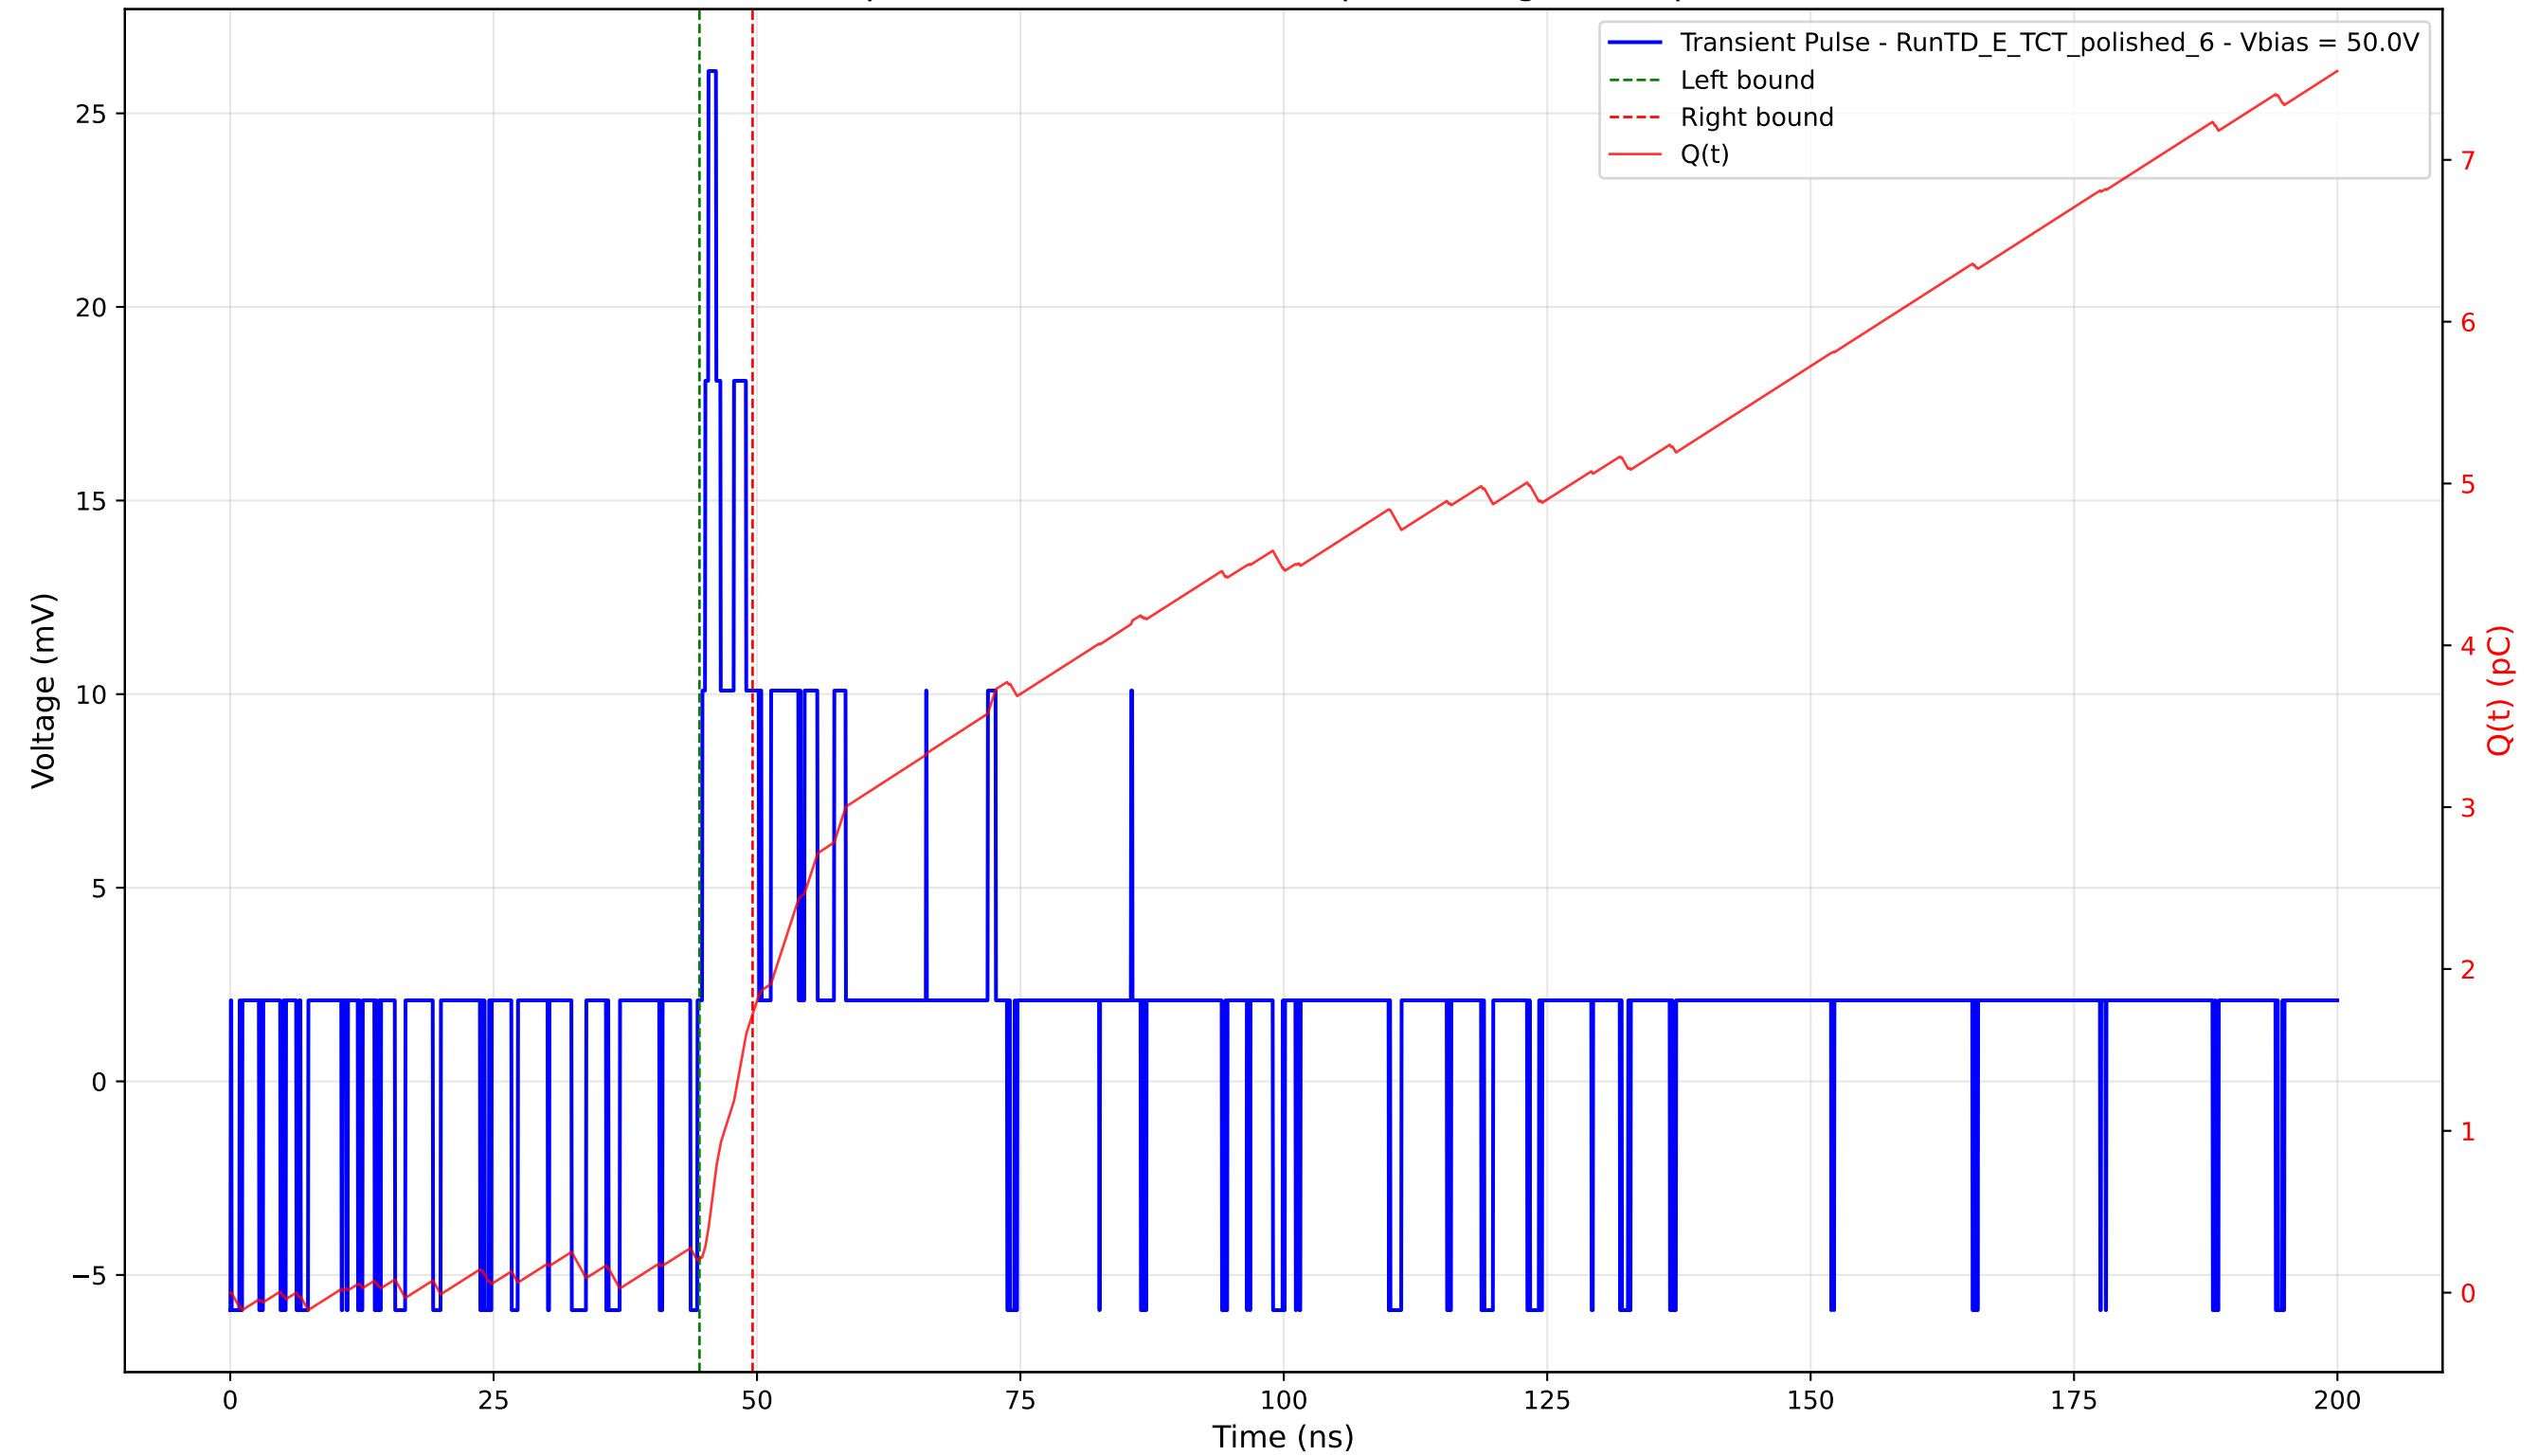


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 2.55 pC - Rise Time: 0.50 ns

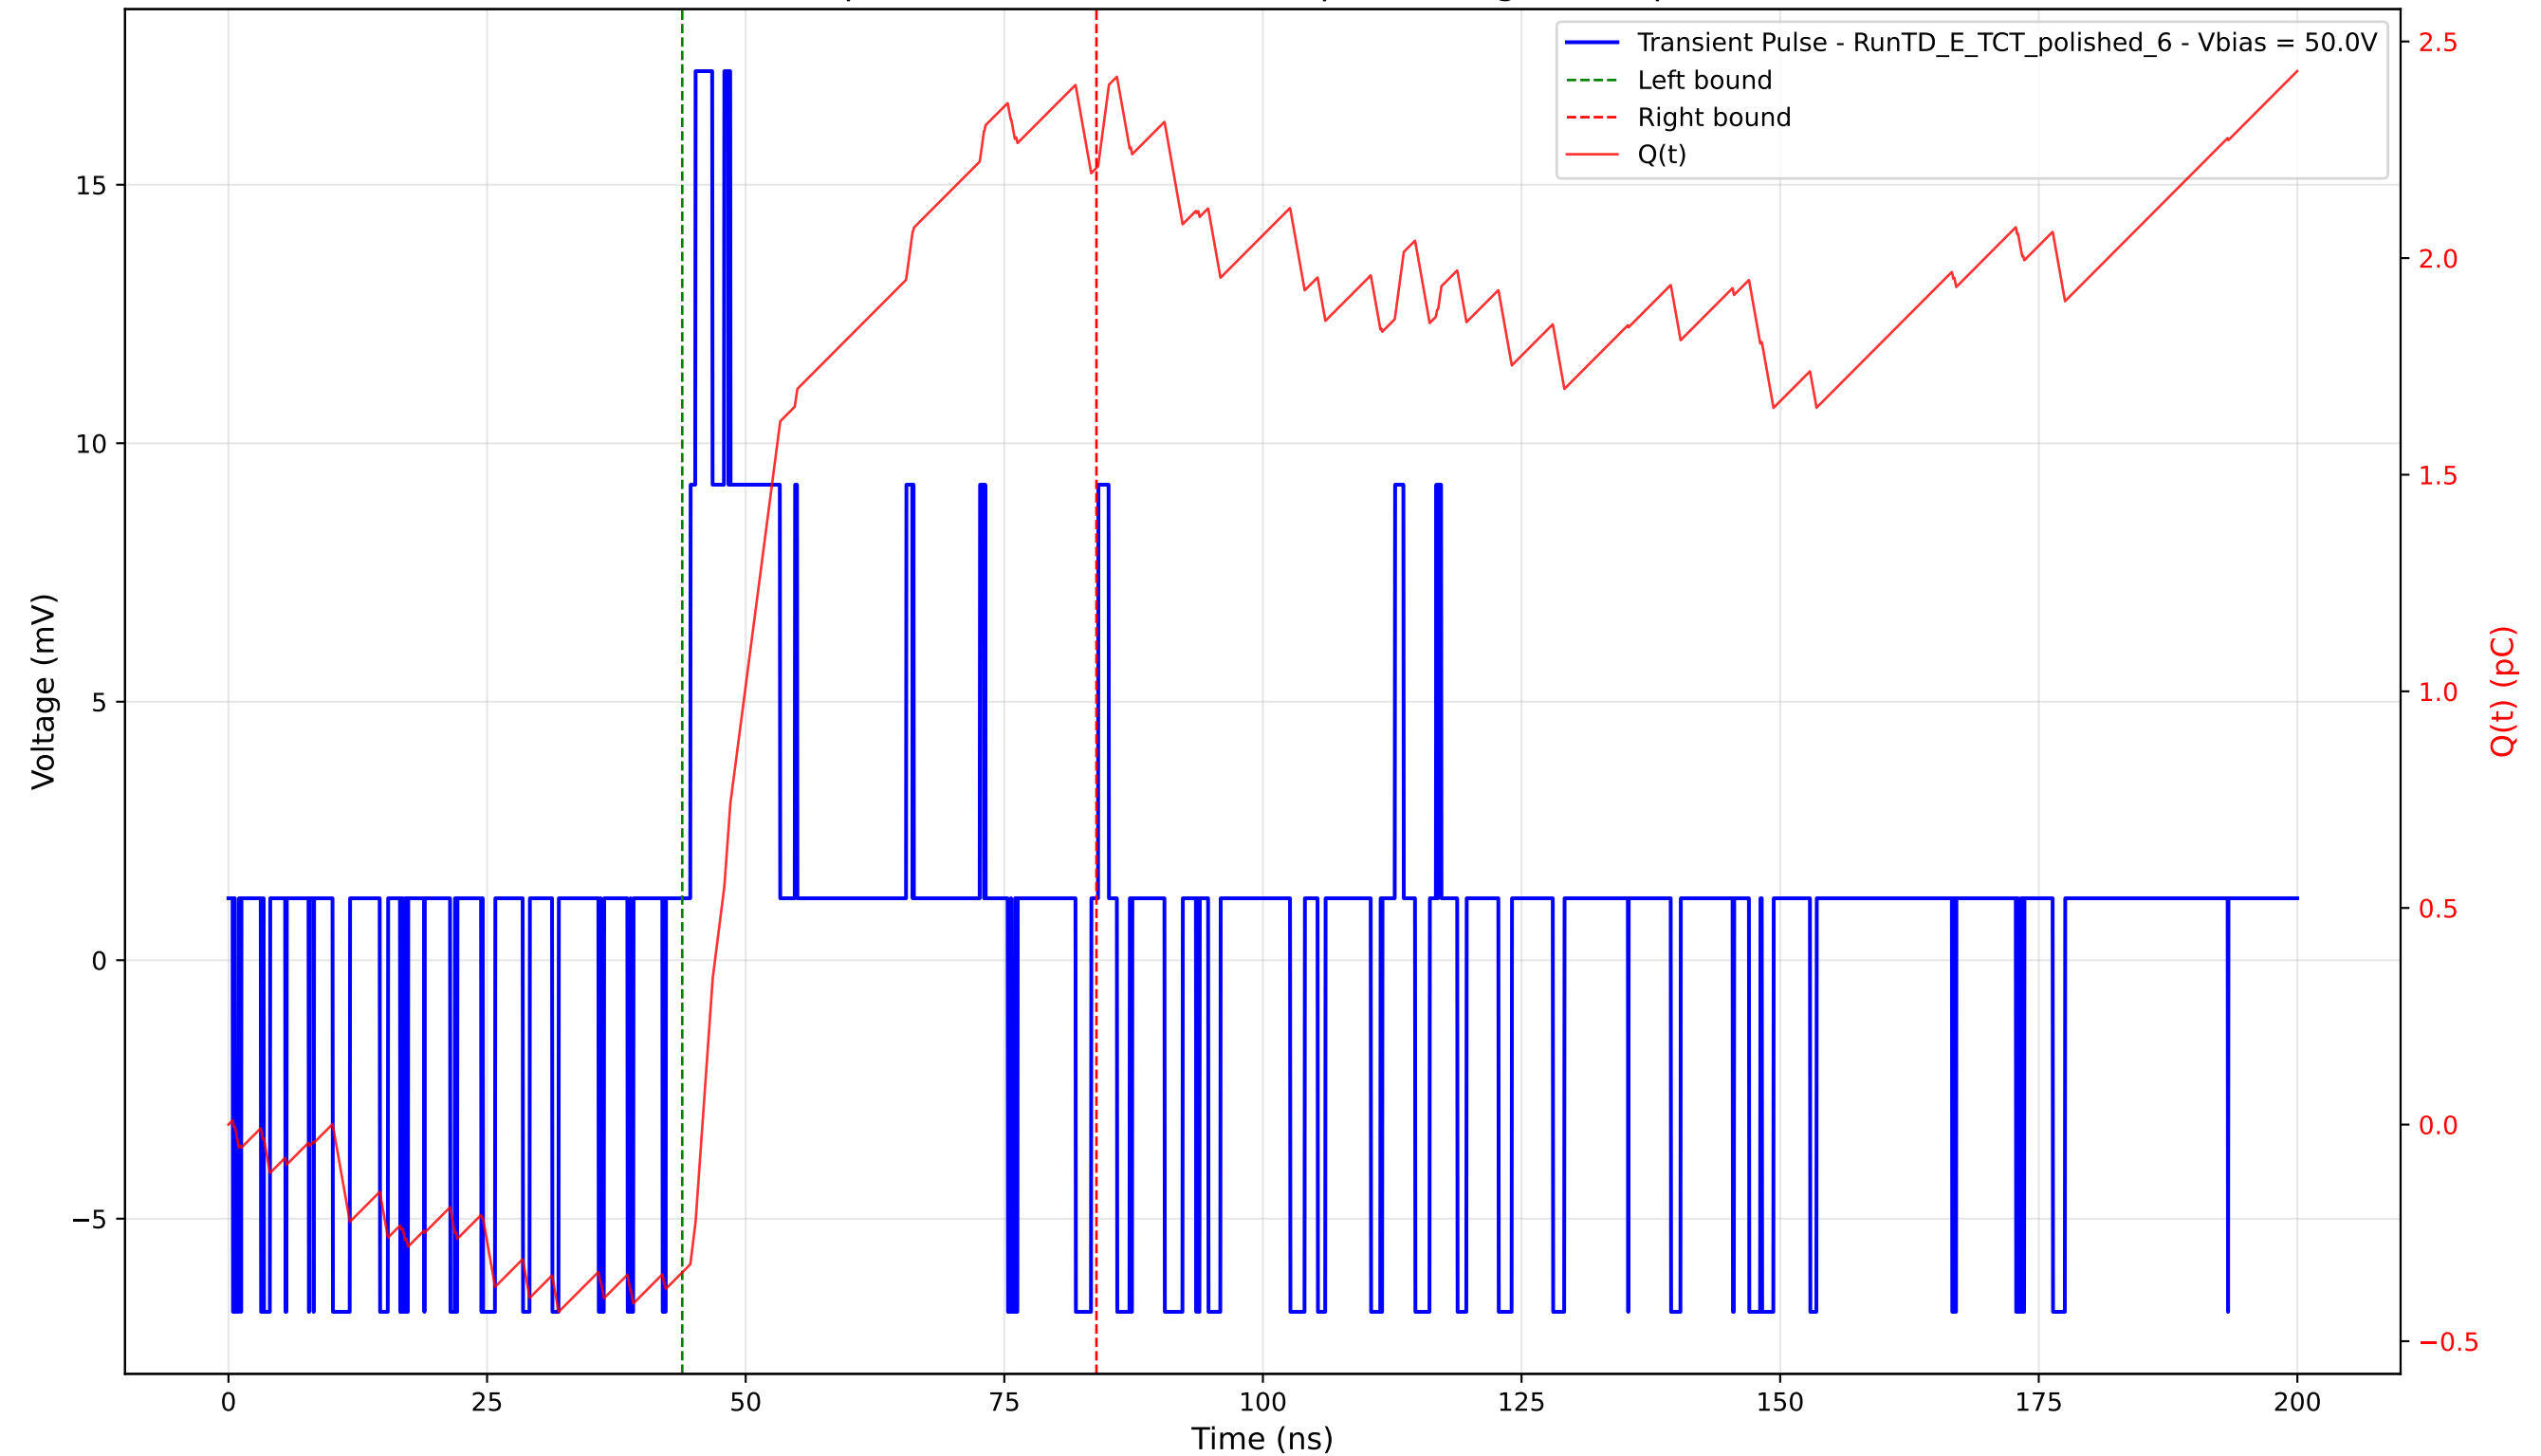


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 2.14 pC - Rise Time: 0.32 ns

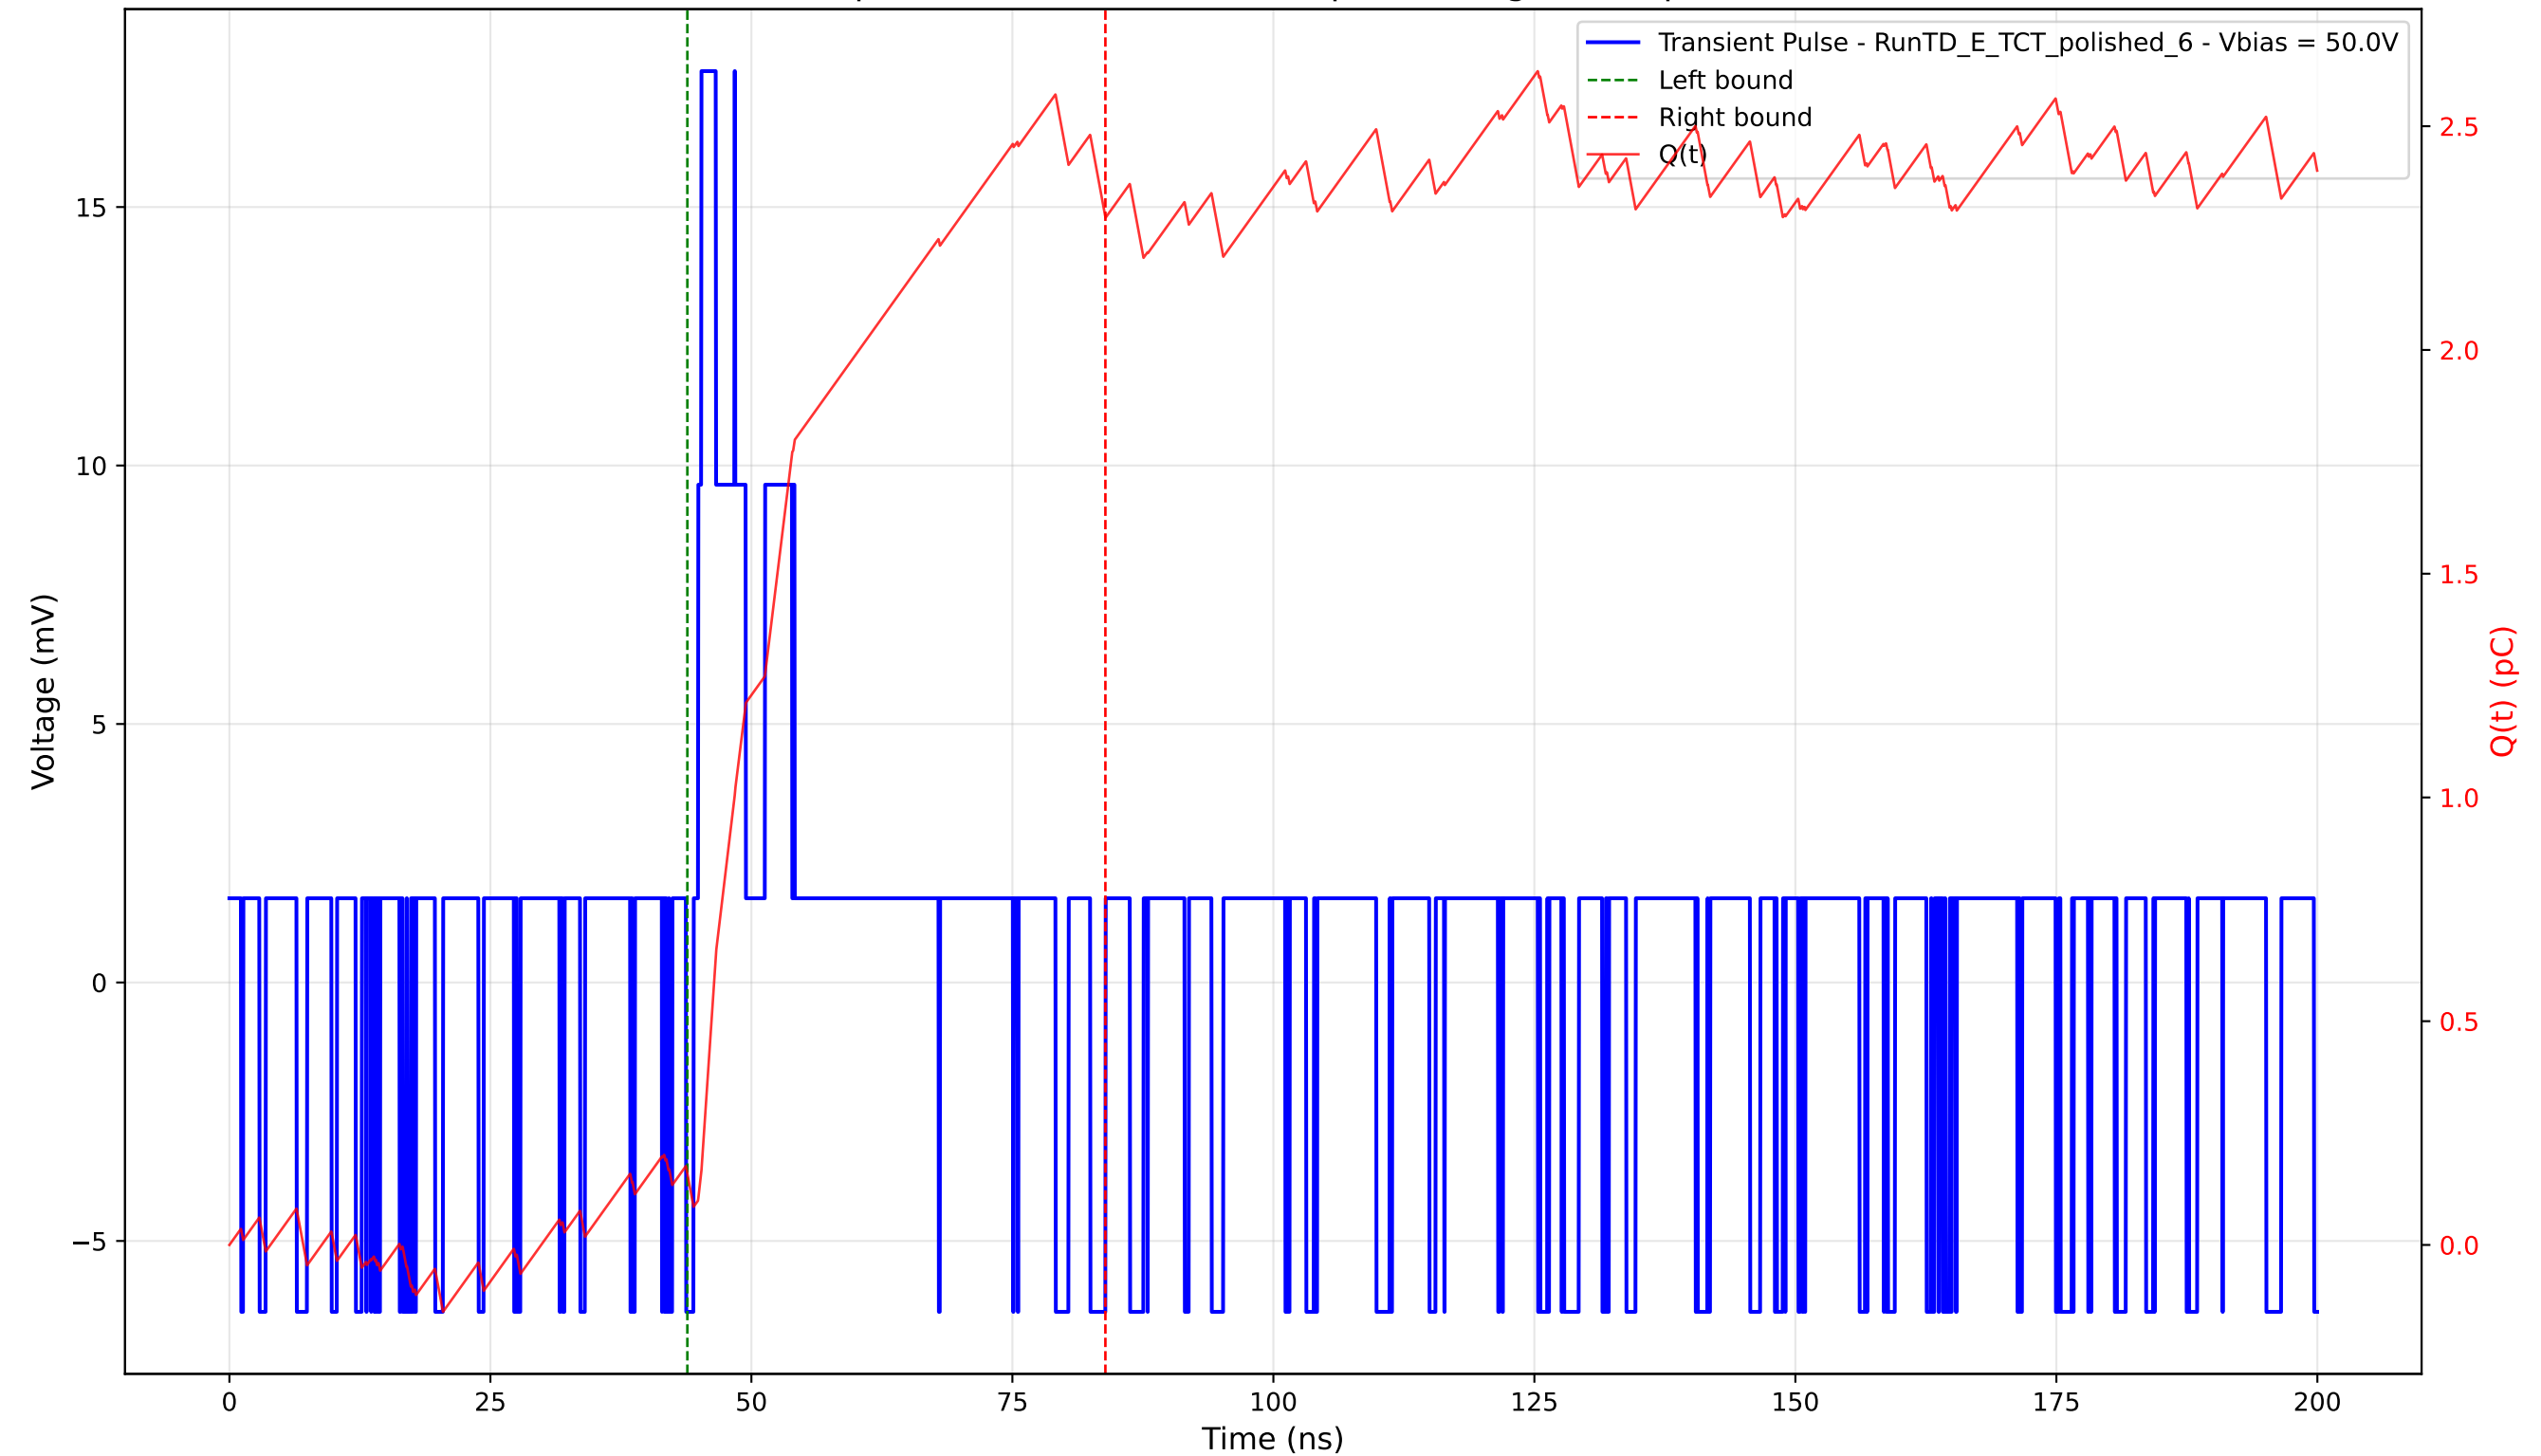


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 2.93 pC - Rise Time: 0.00 ns (N/A)

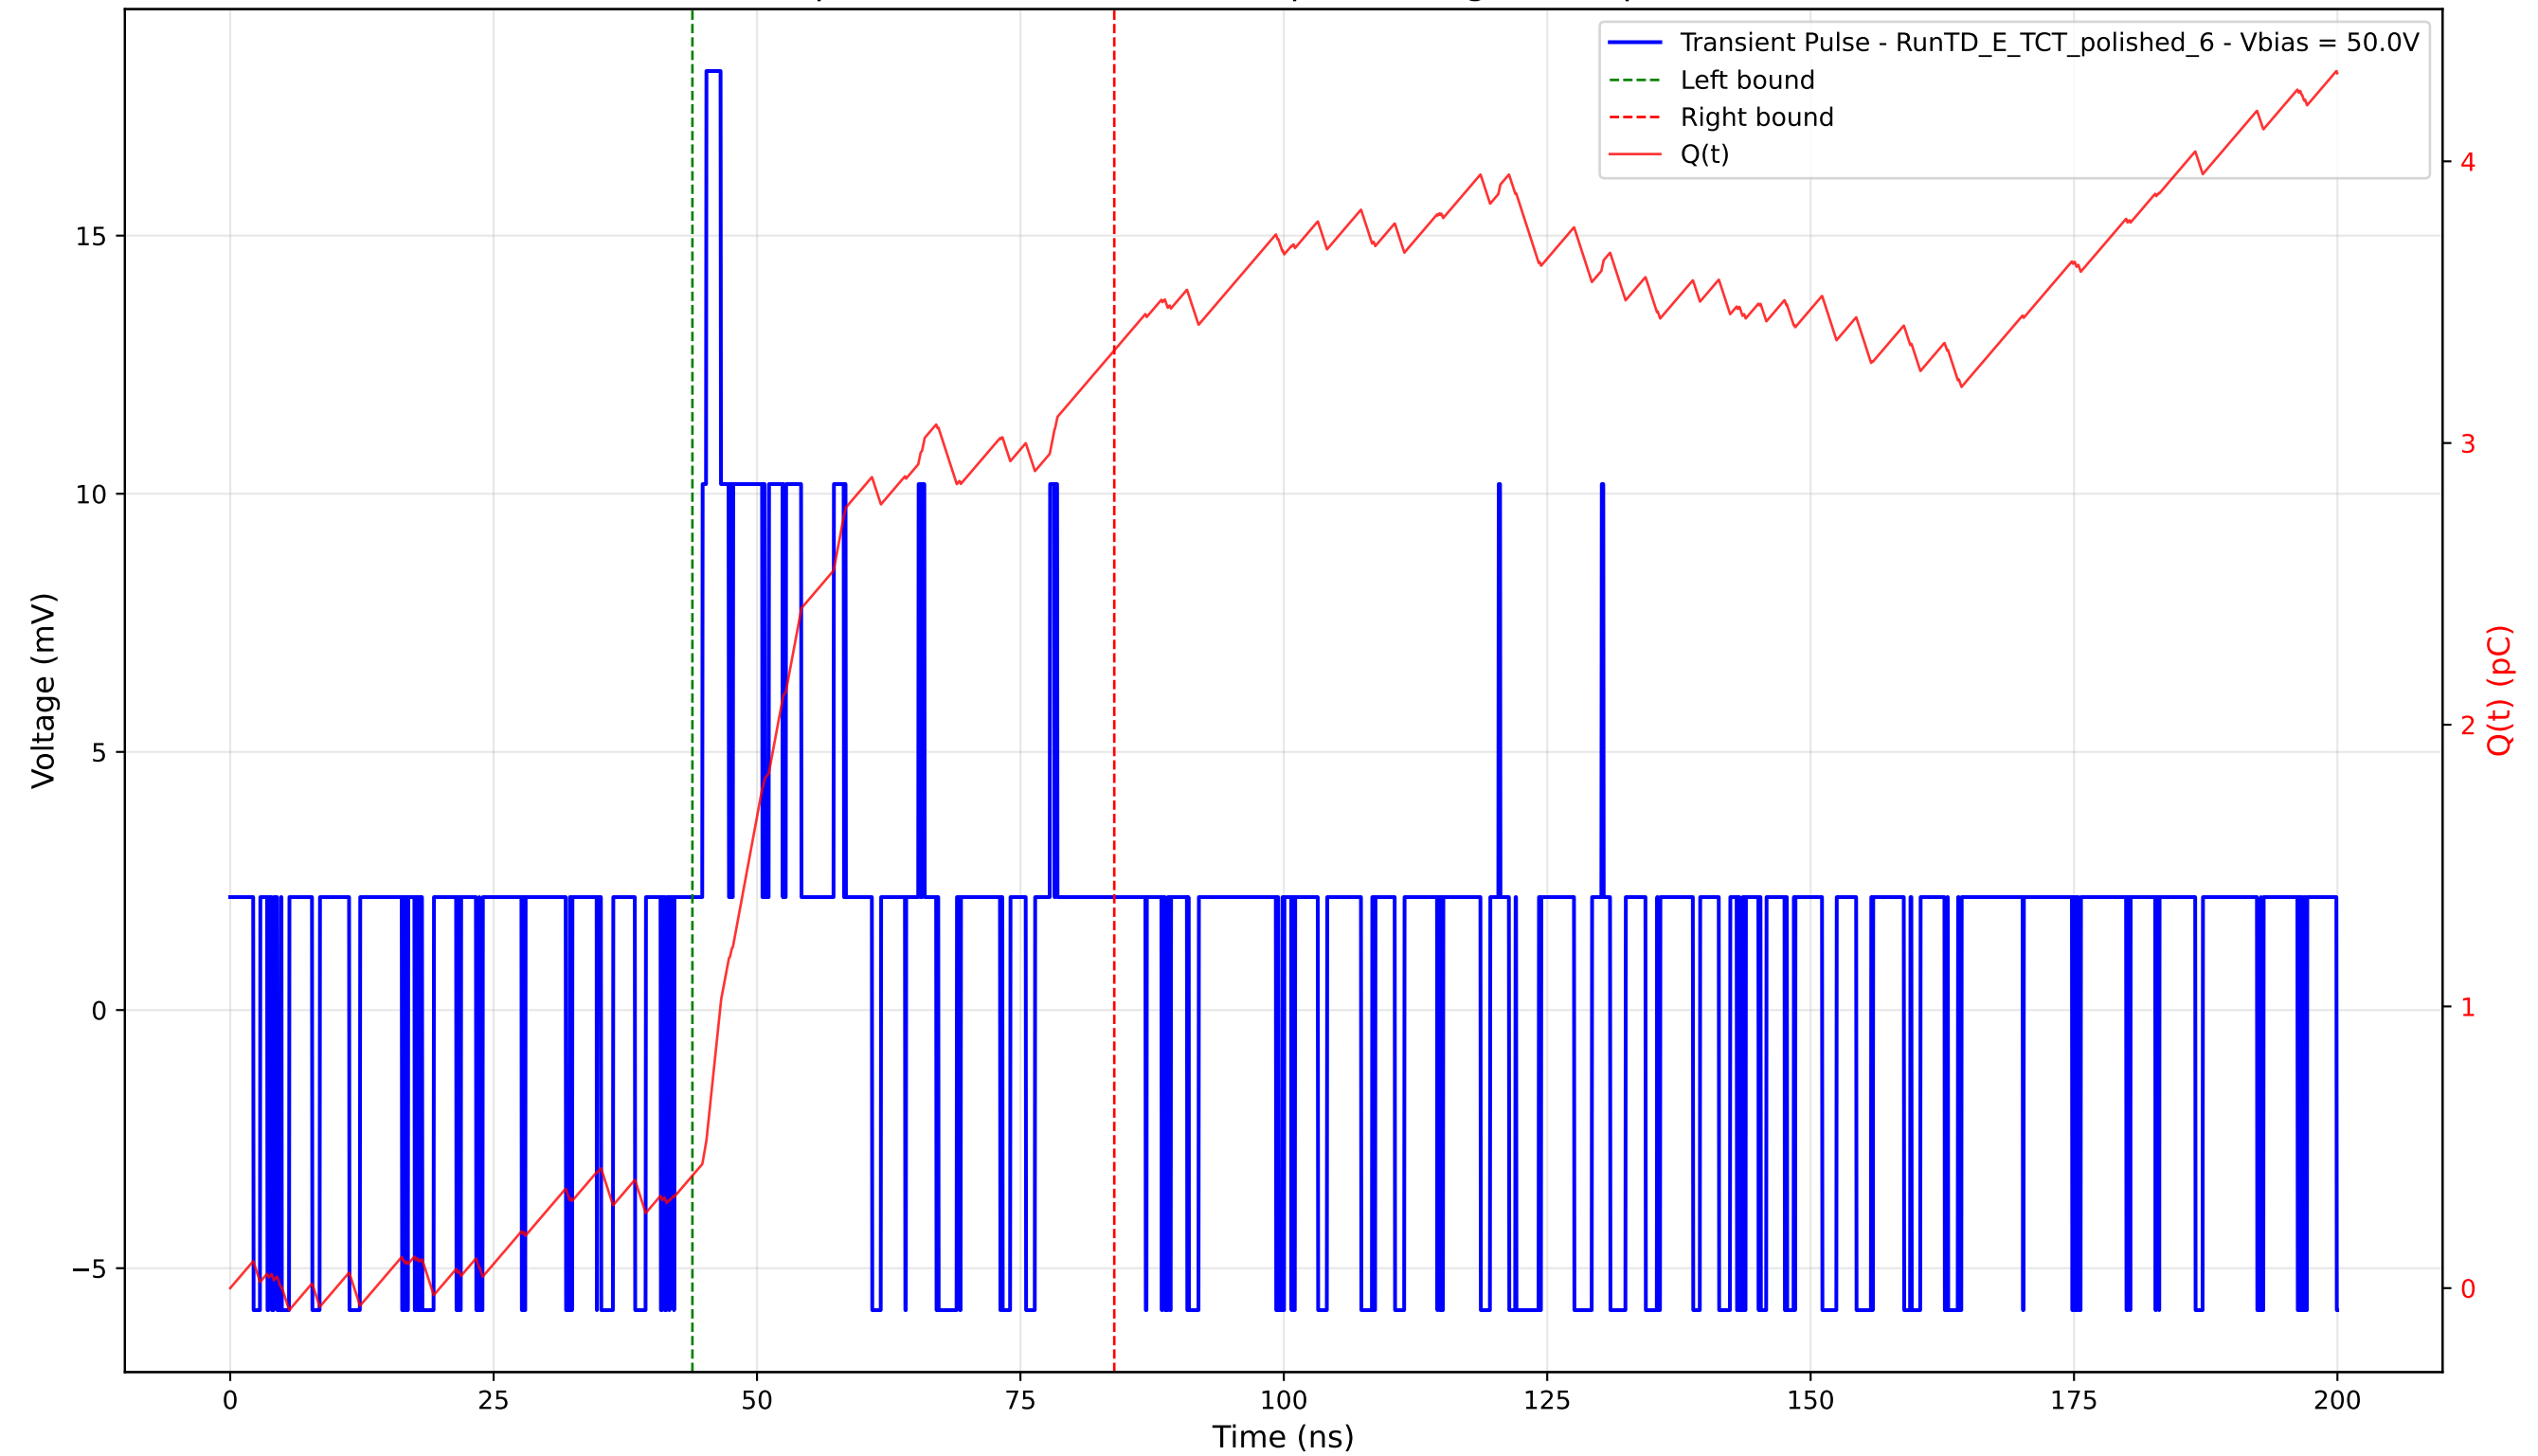


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 2.80 pC - Rise Time: 0.00 ns (N/A)

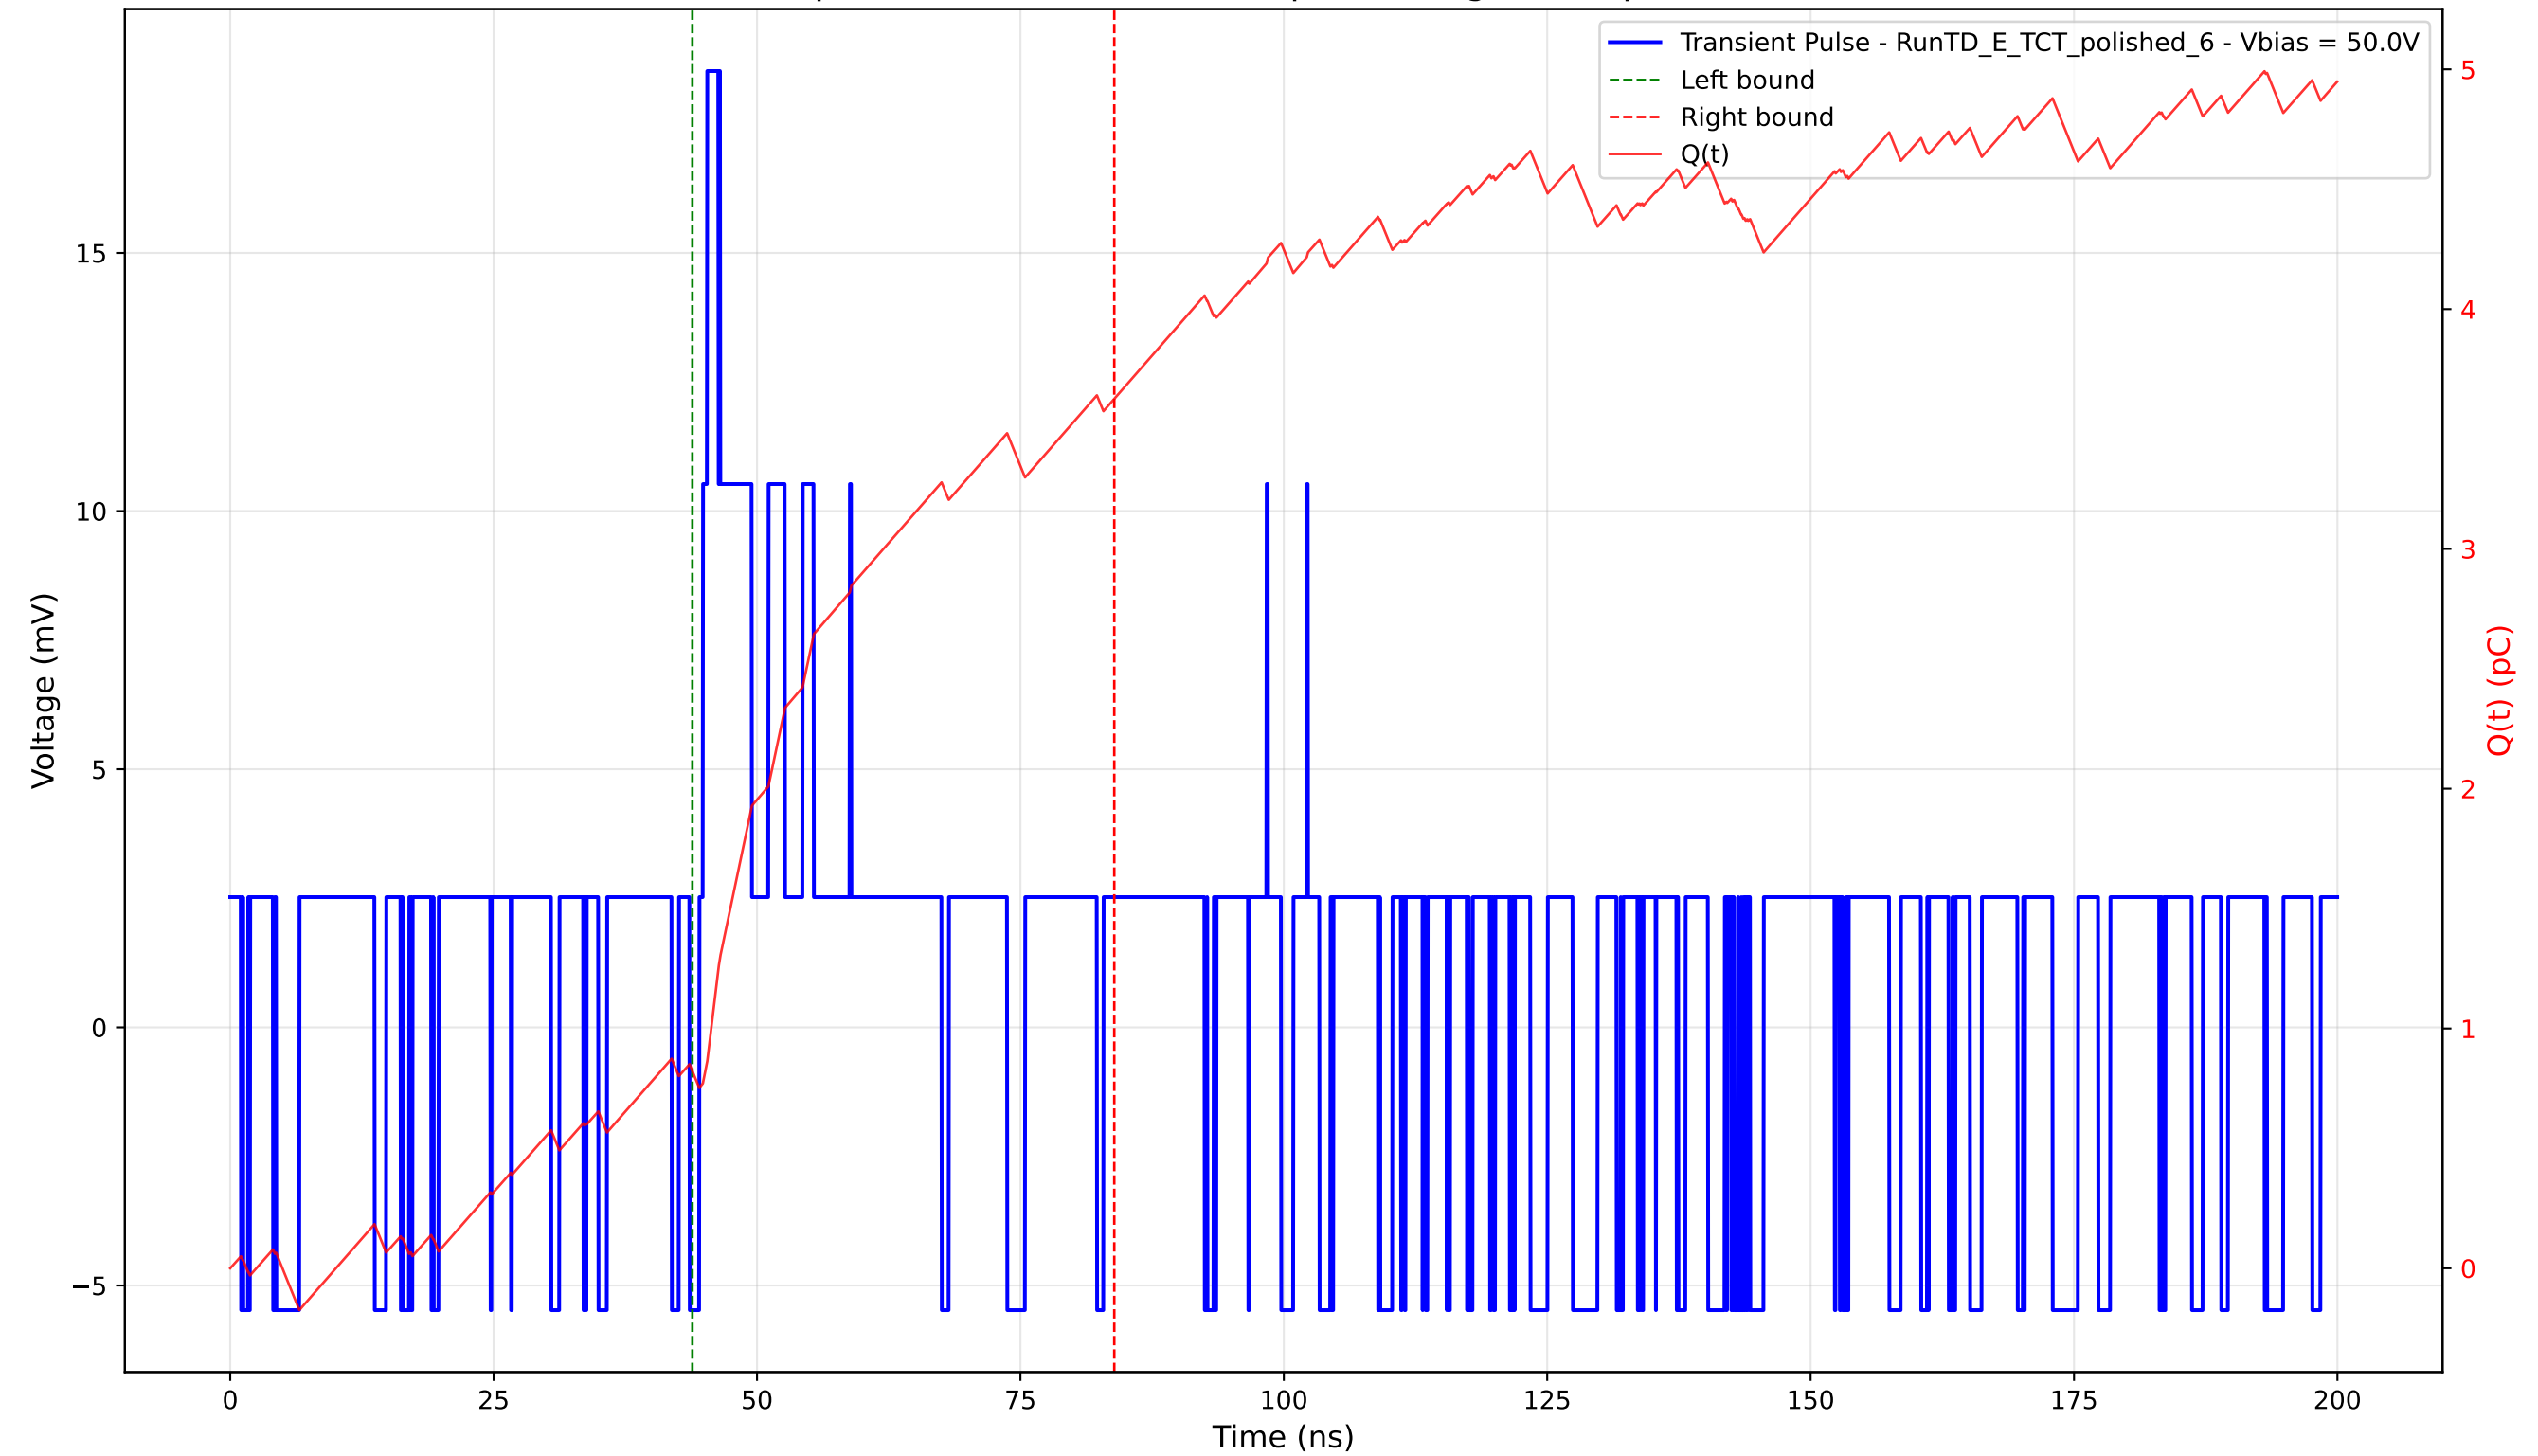


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 2.71 pC - Rise Time: 0.00 ns (N/A)

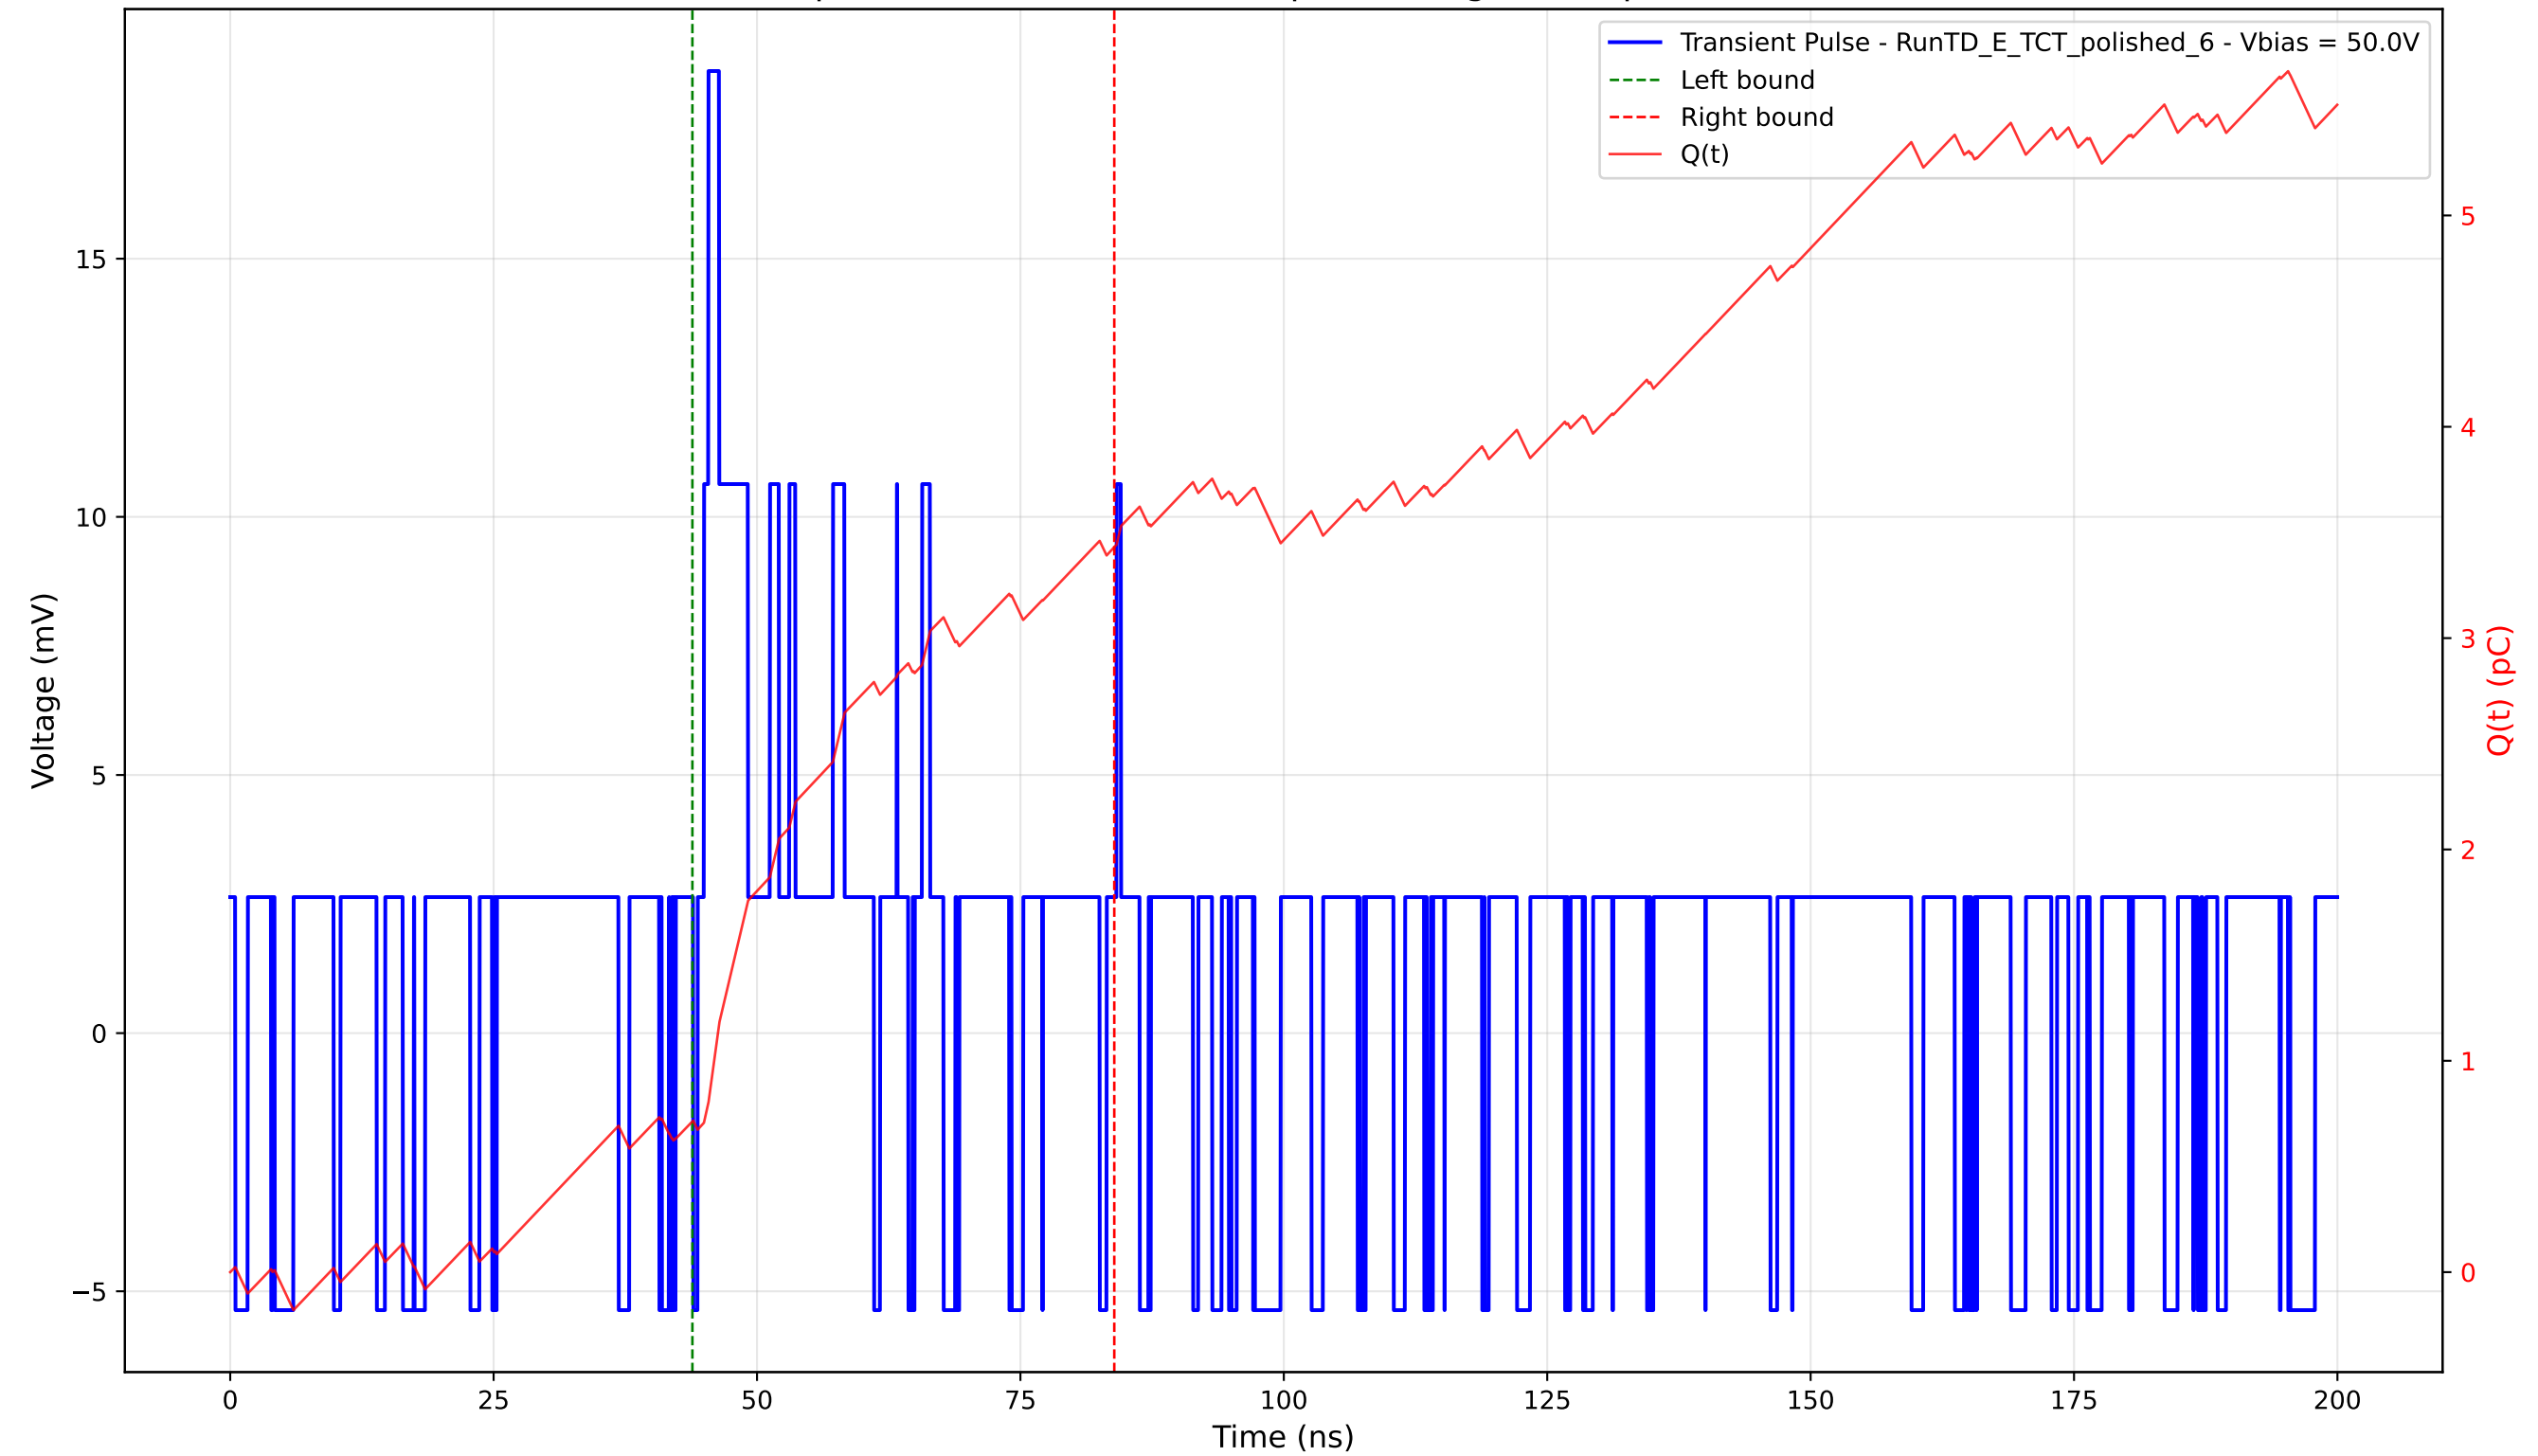


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 1.25 pC - Rise Time: 0.00 ns (N/A)

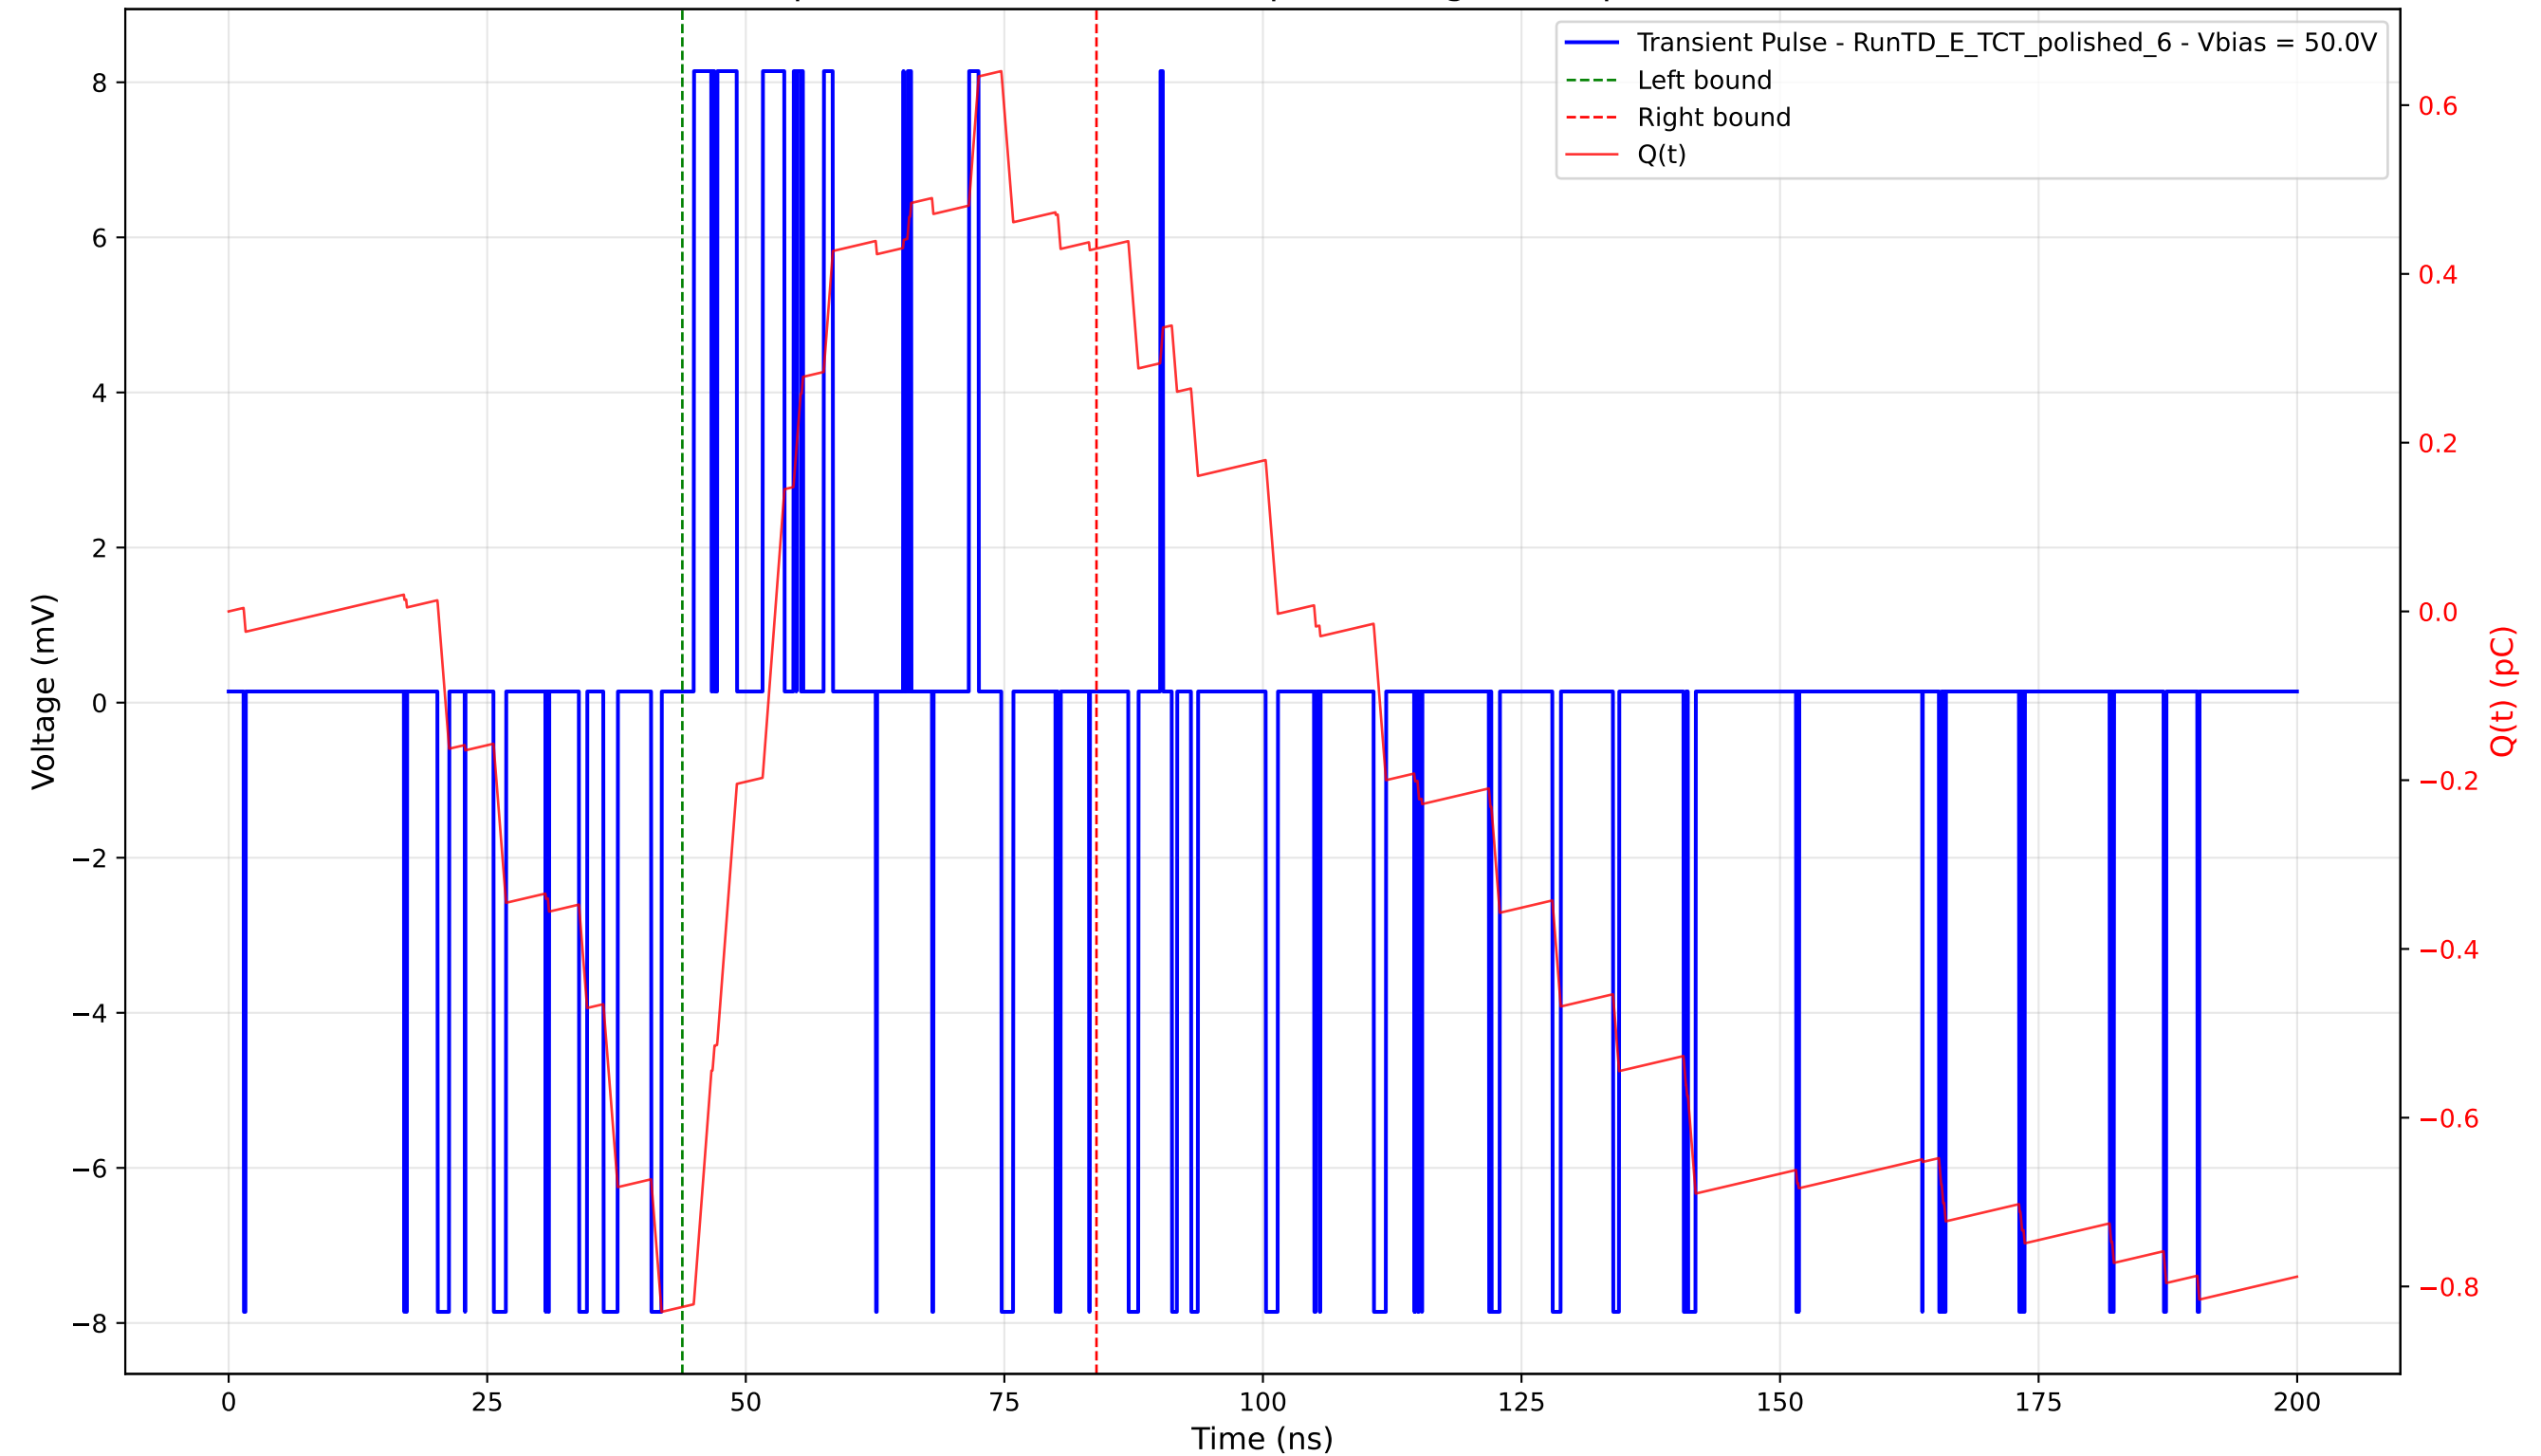


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 2.60 pC - Rise Time: 0.00 ns (N/A)

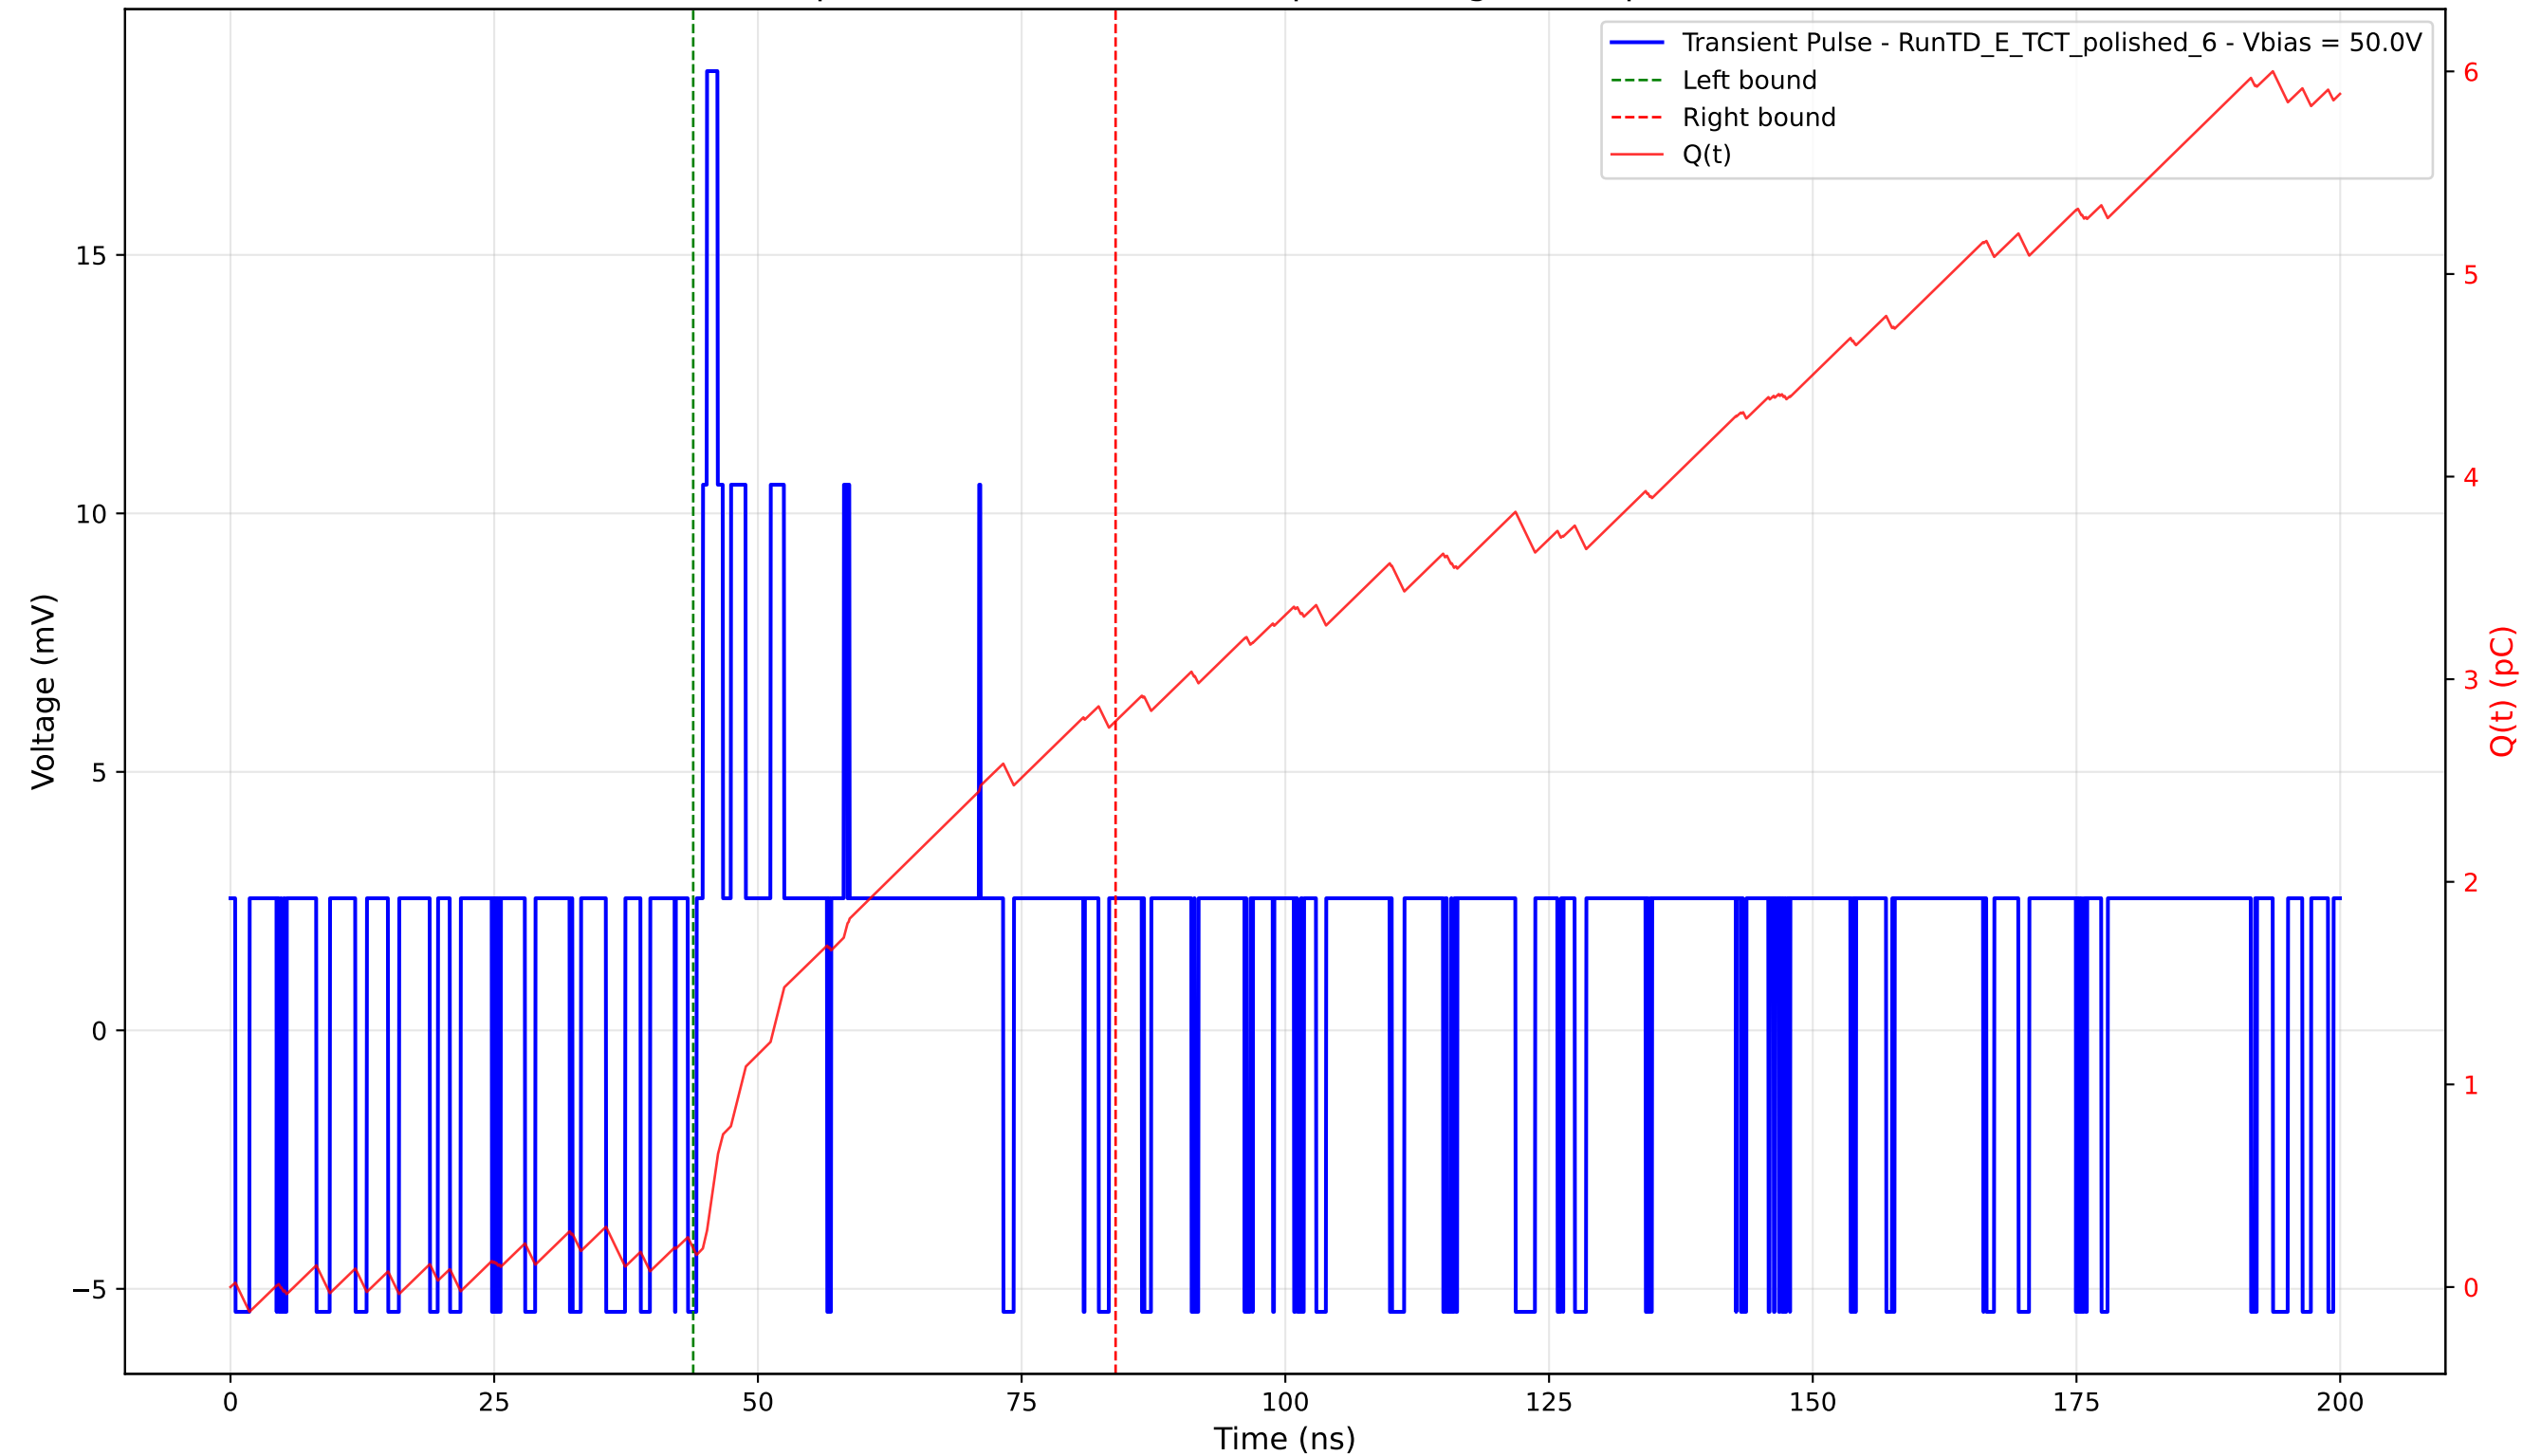


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 2.57 pC - Rise Time: 0.00 ns (N/A)

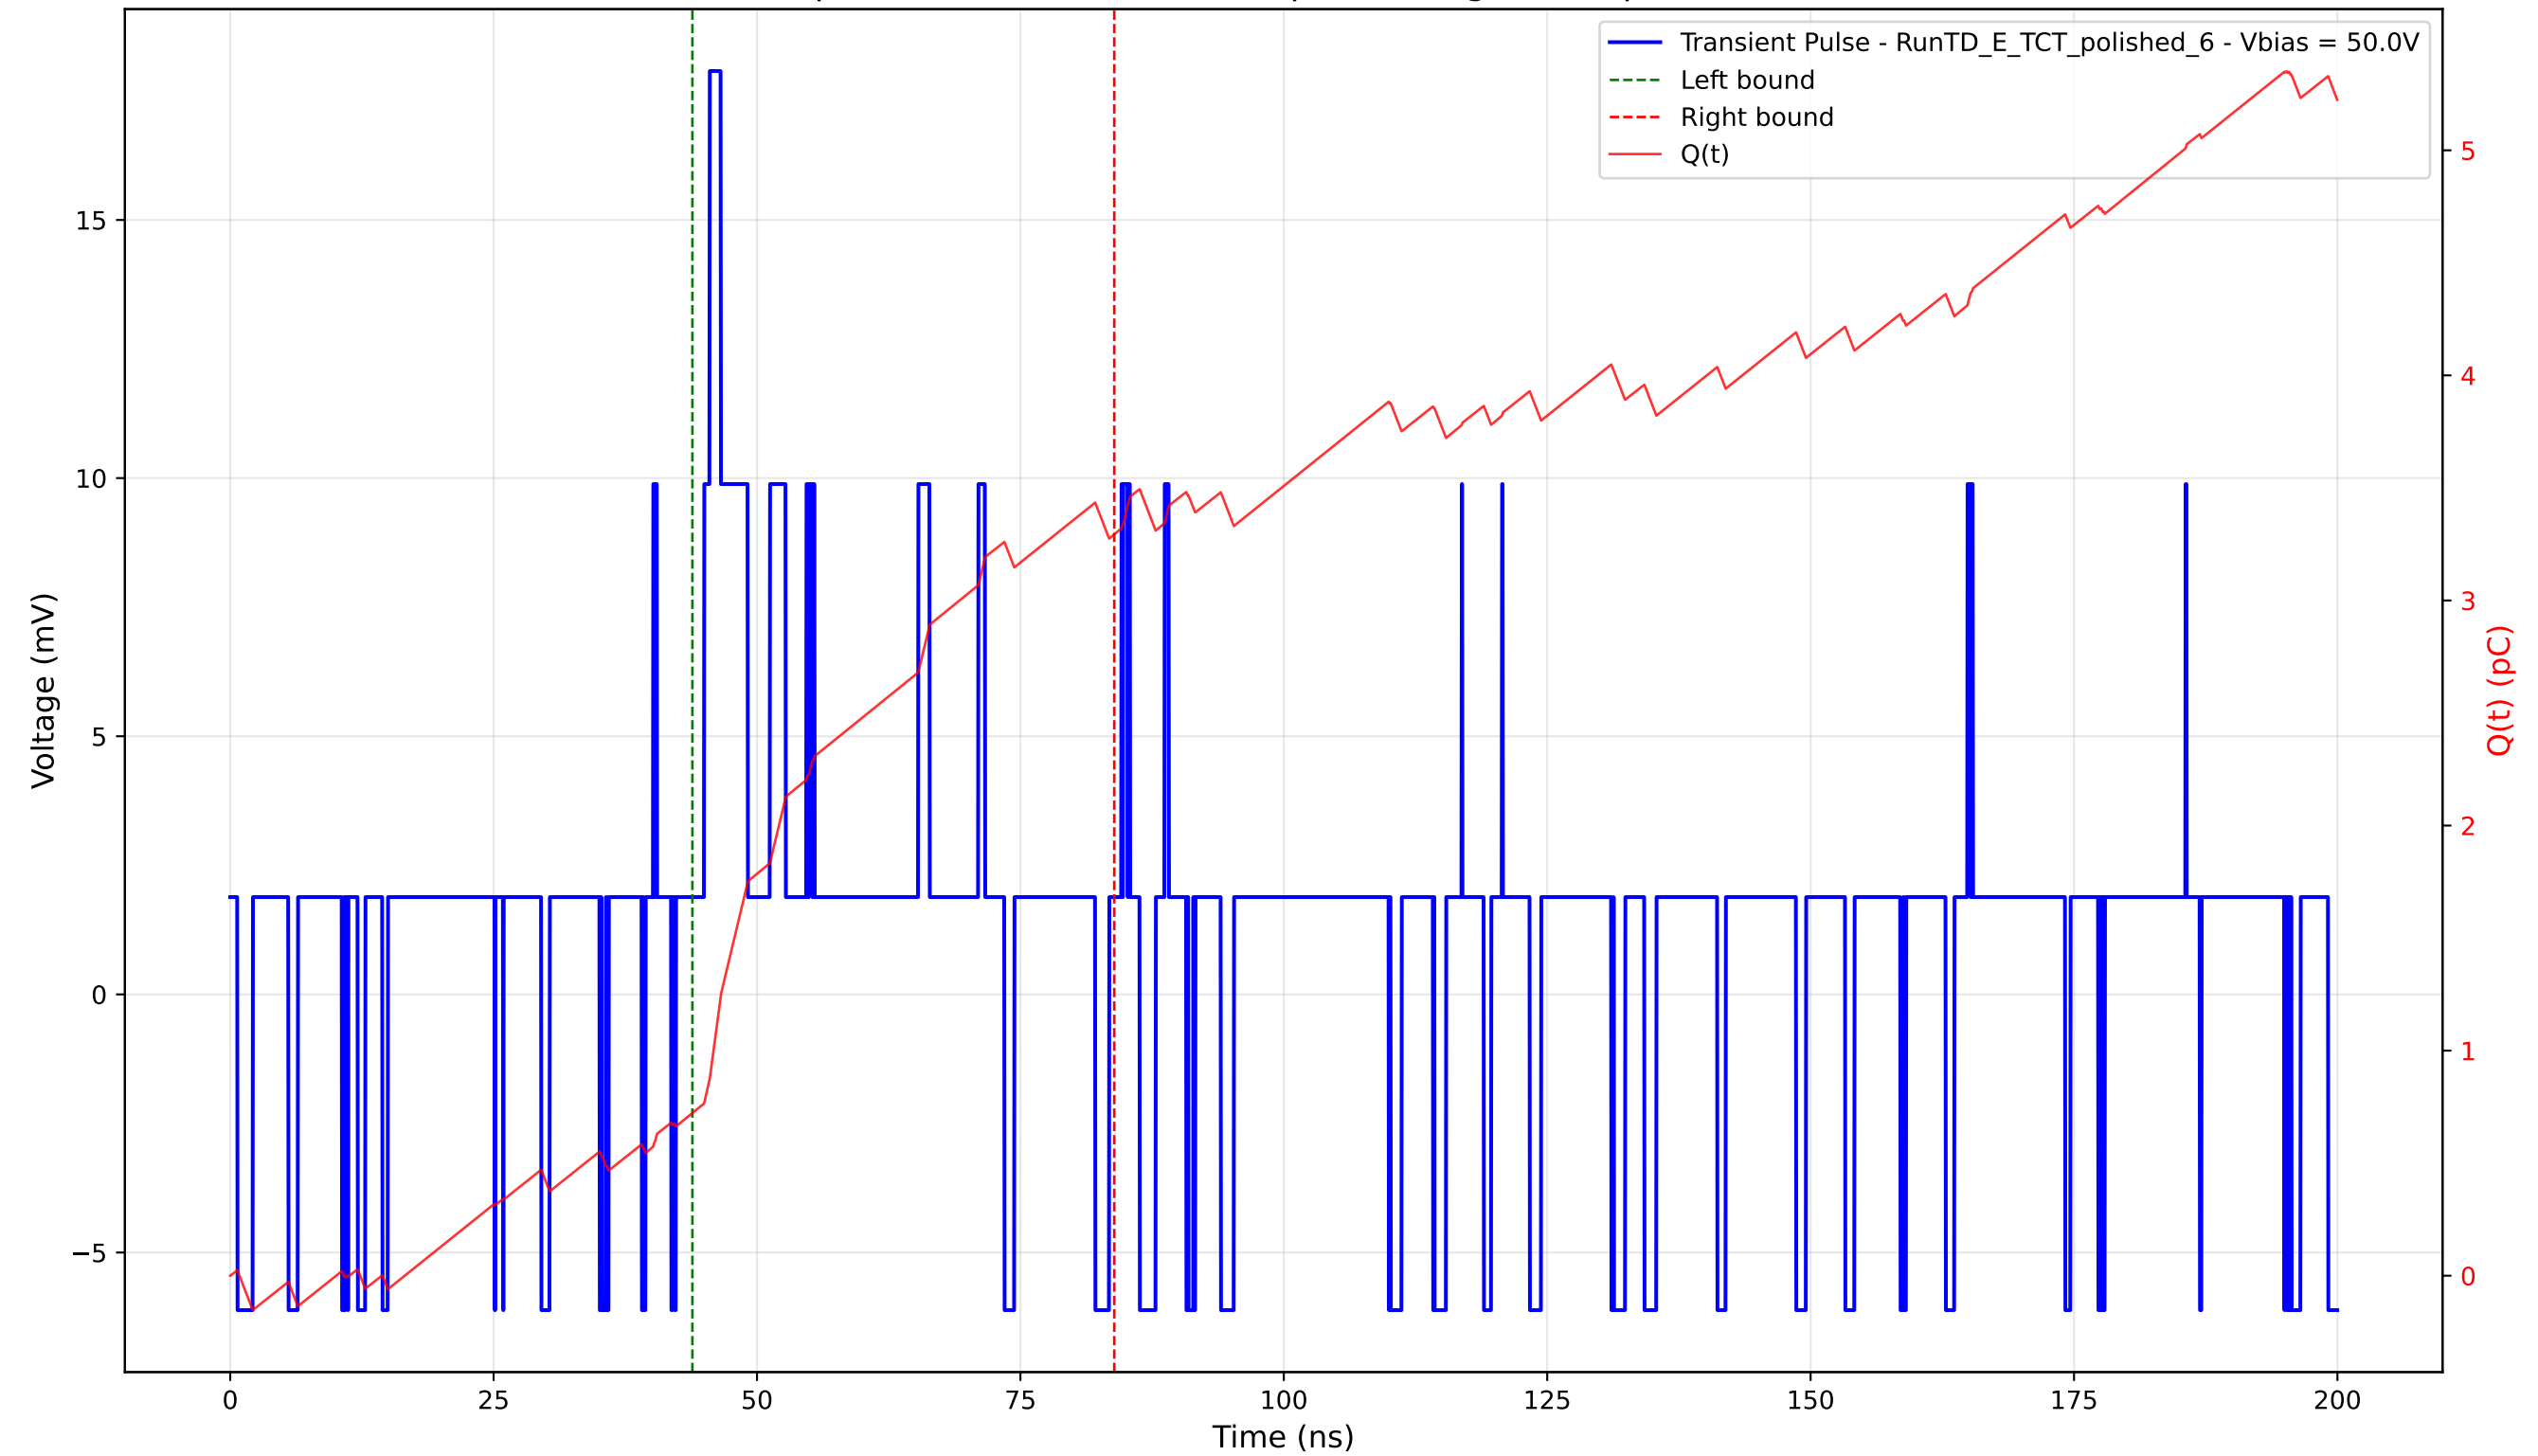


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 1.61 pC - Rise Time: 0.00 ns (N/A)

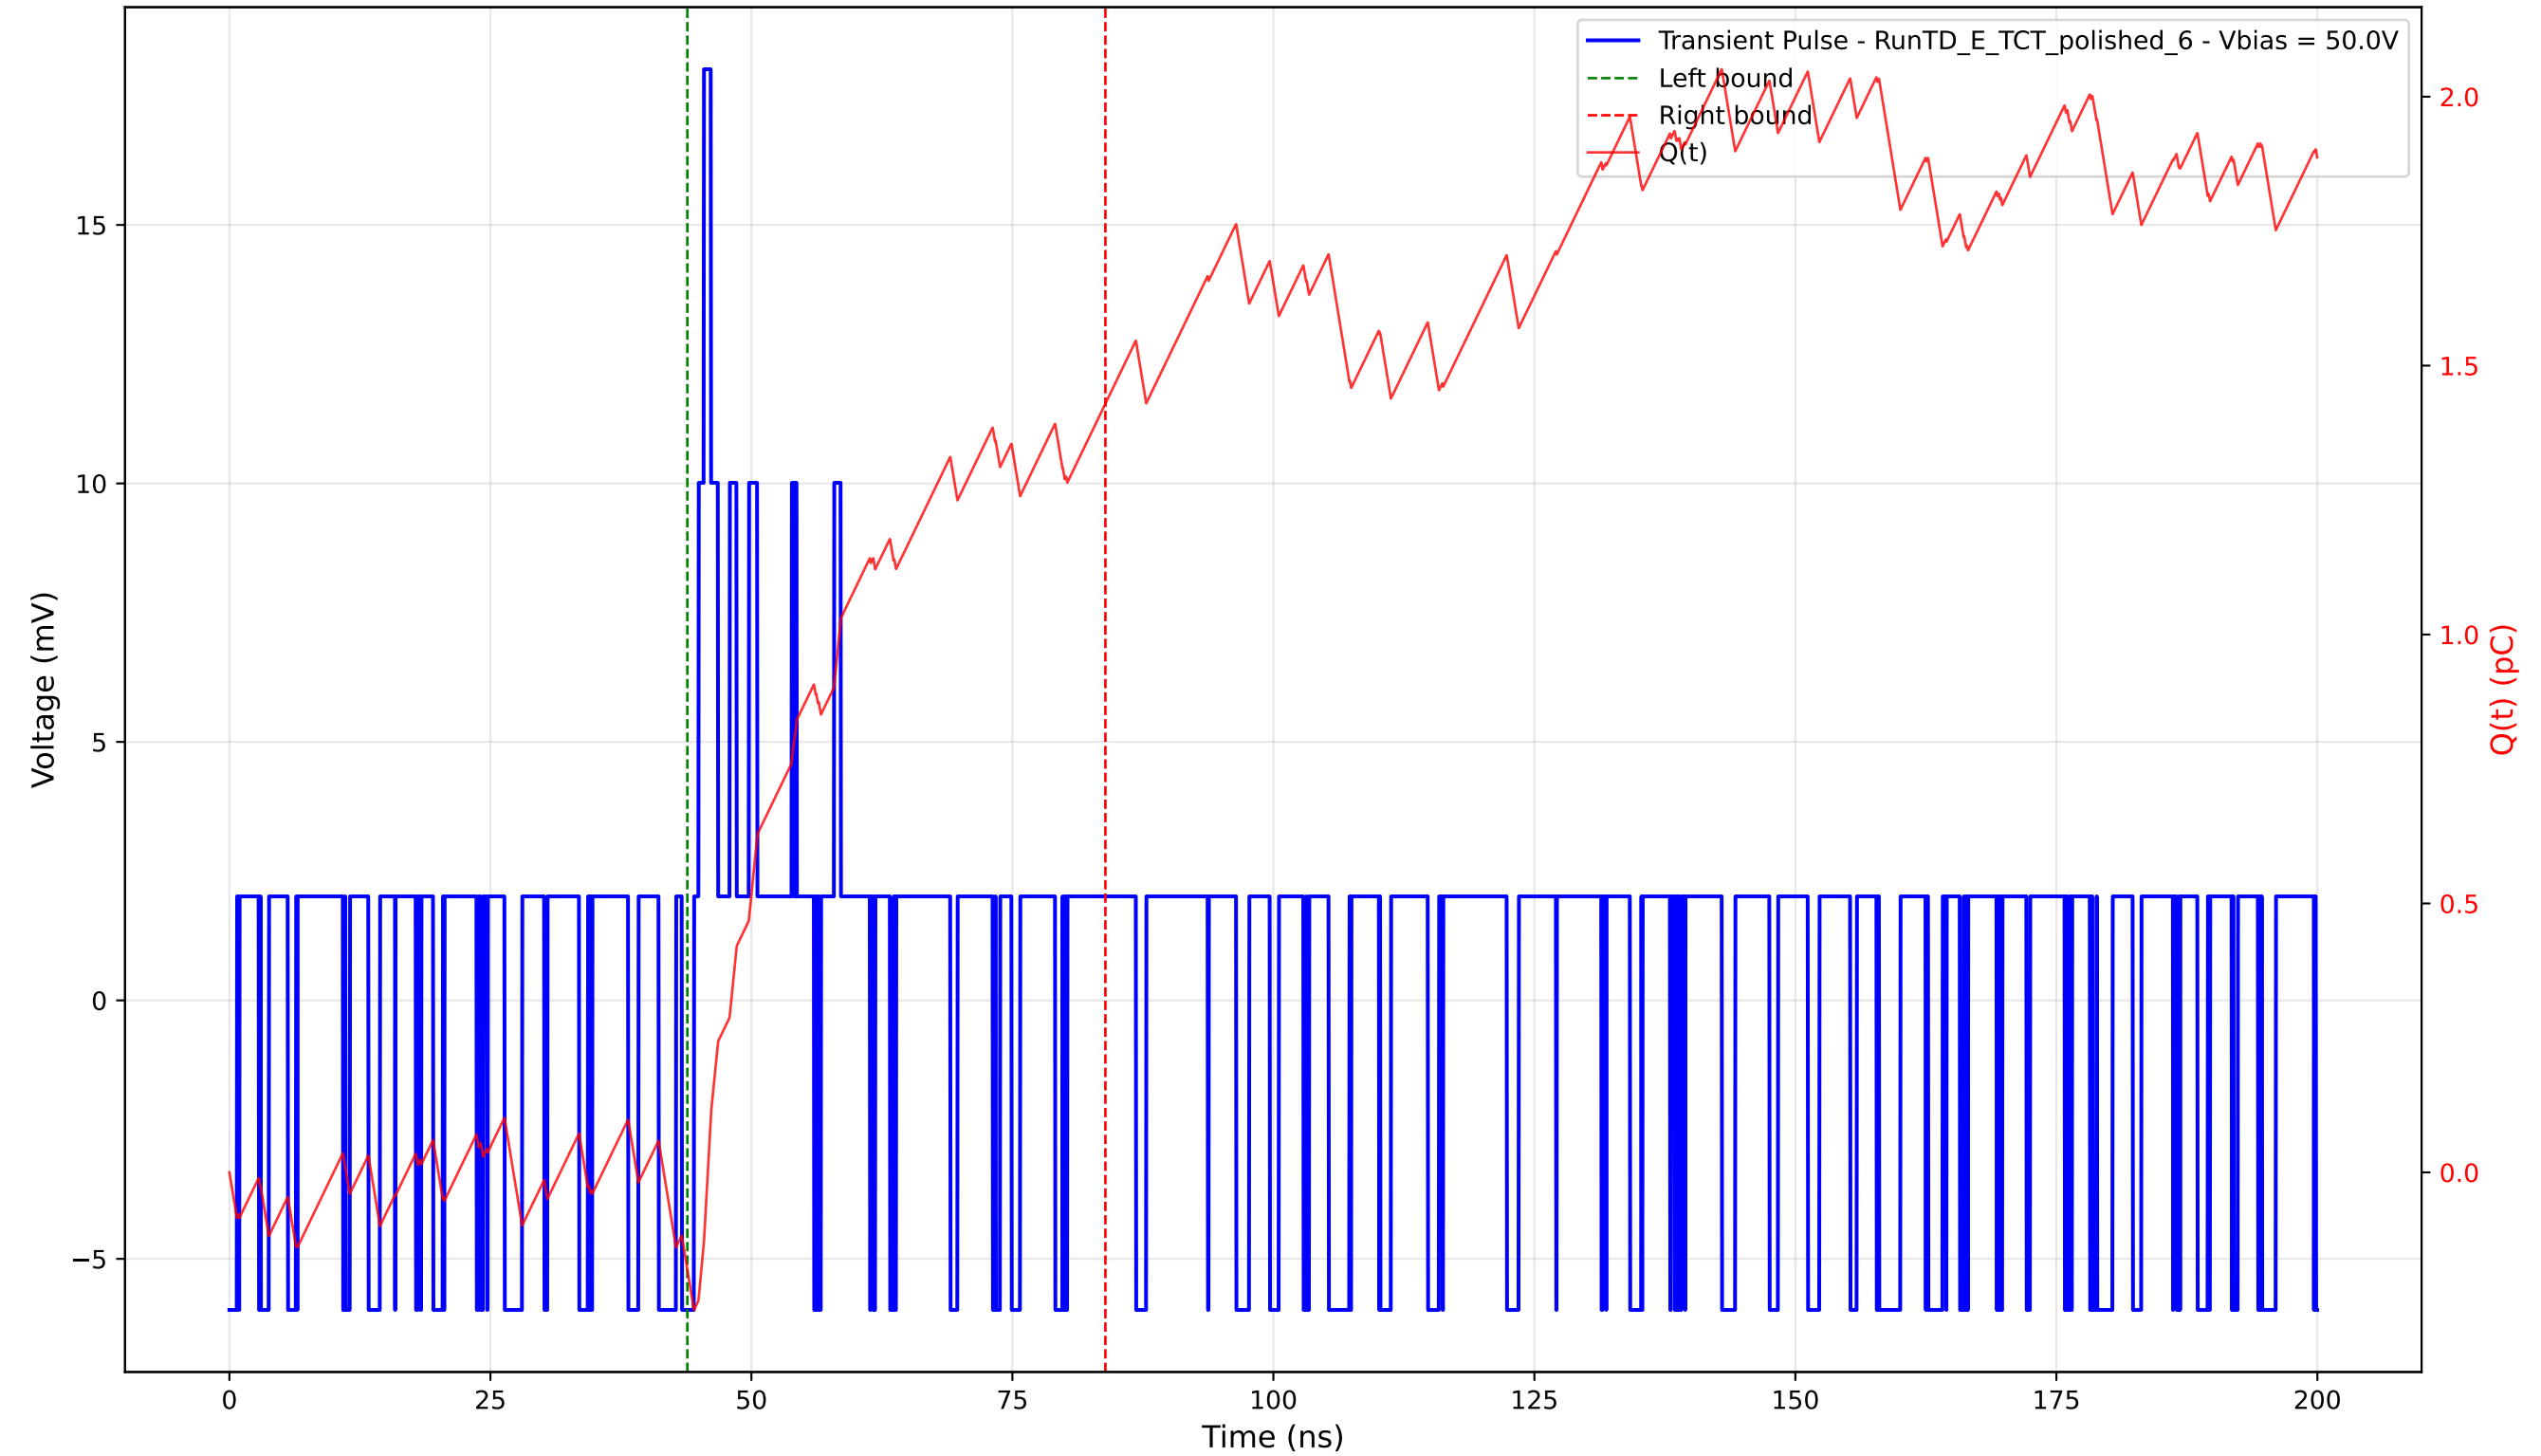


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 0.91 pC - Rise Time: 0.64 ns

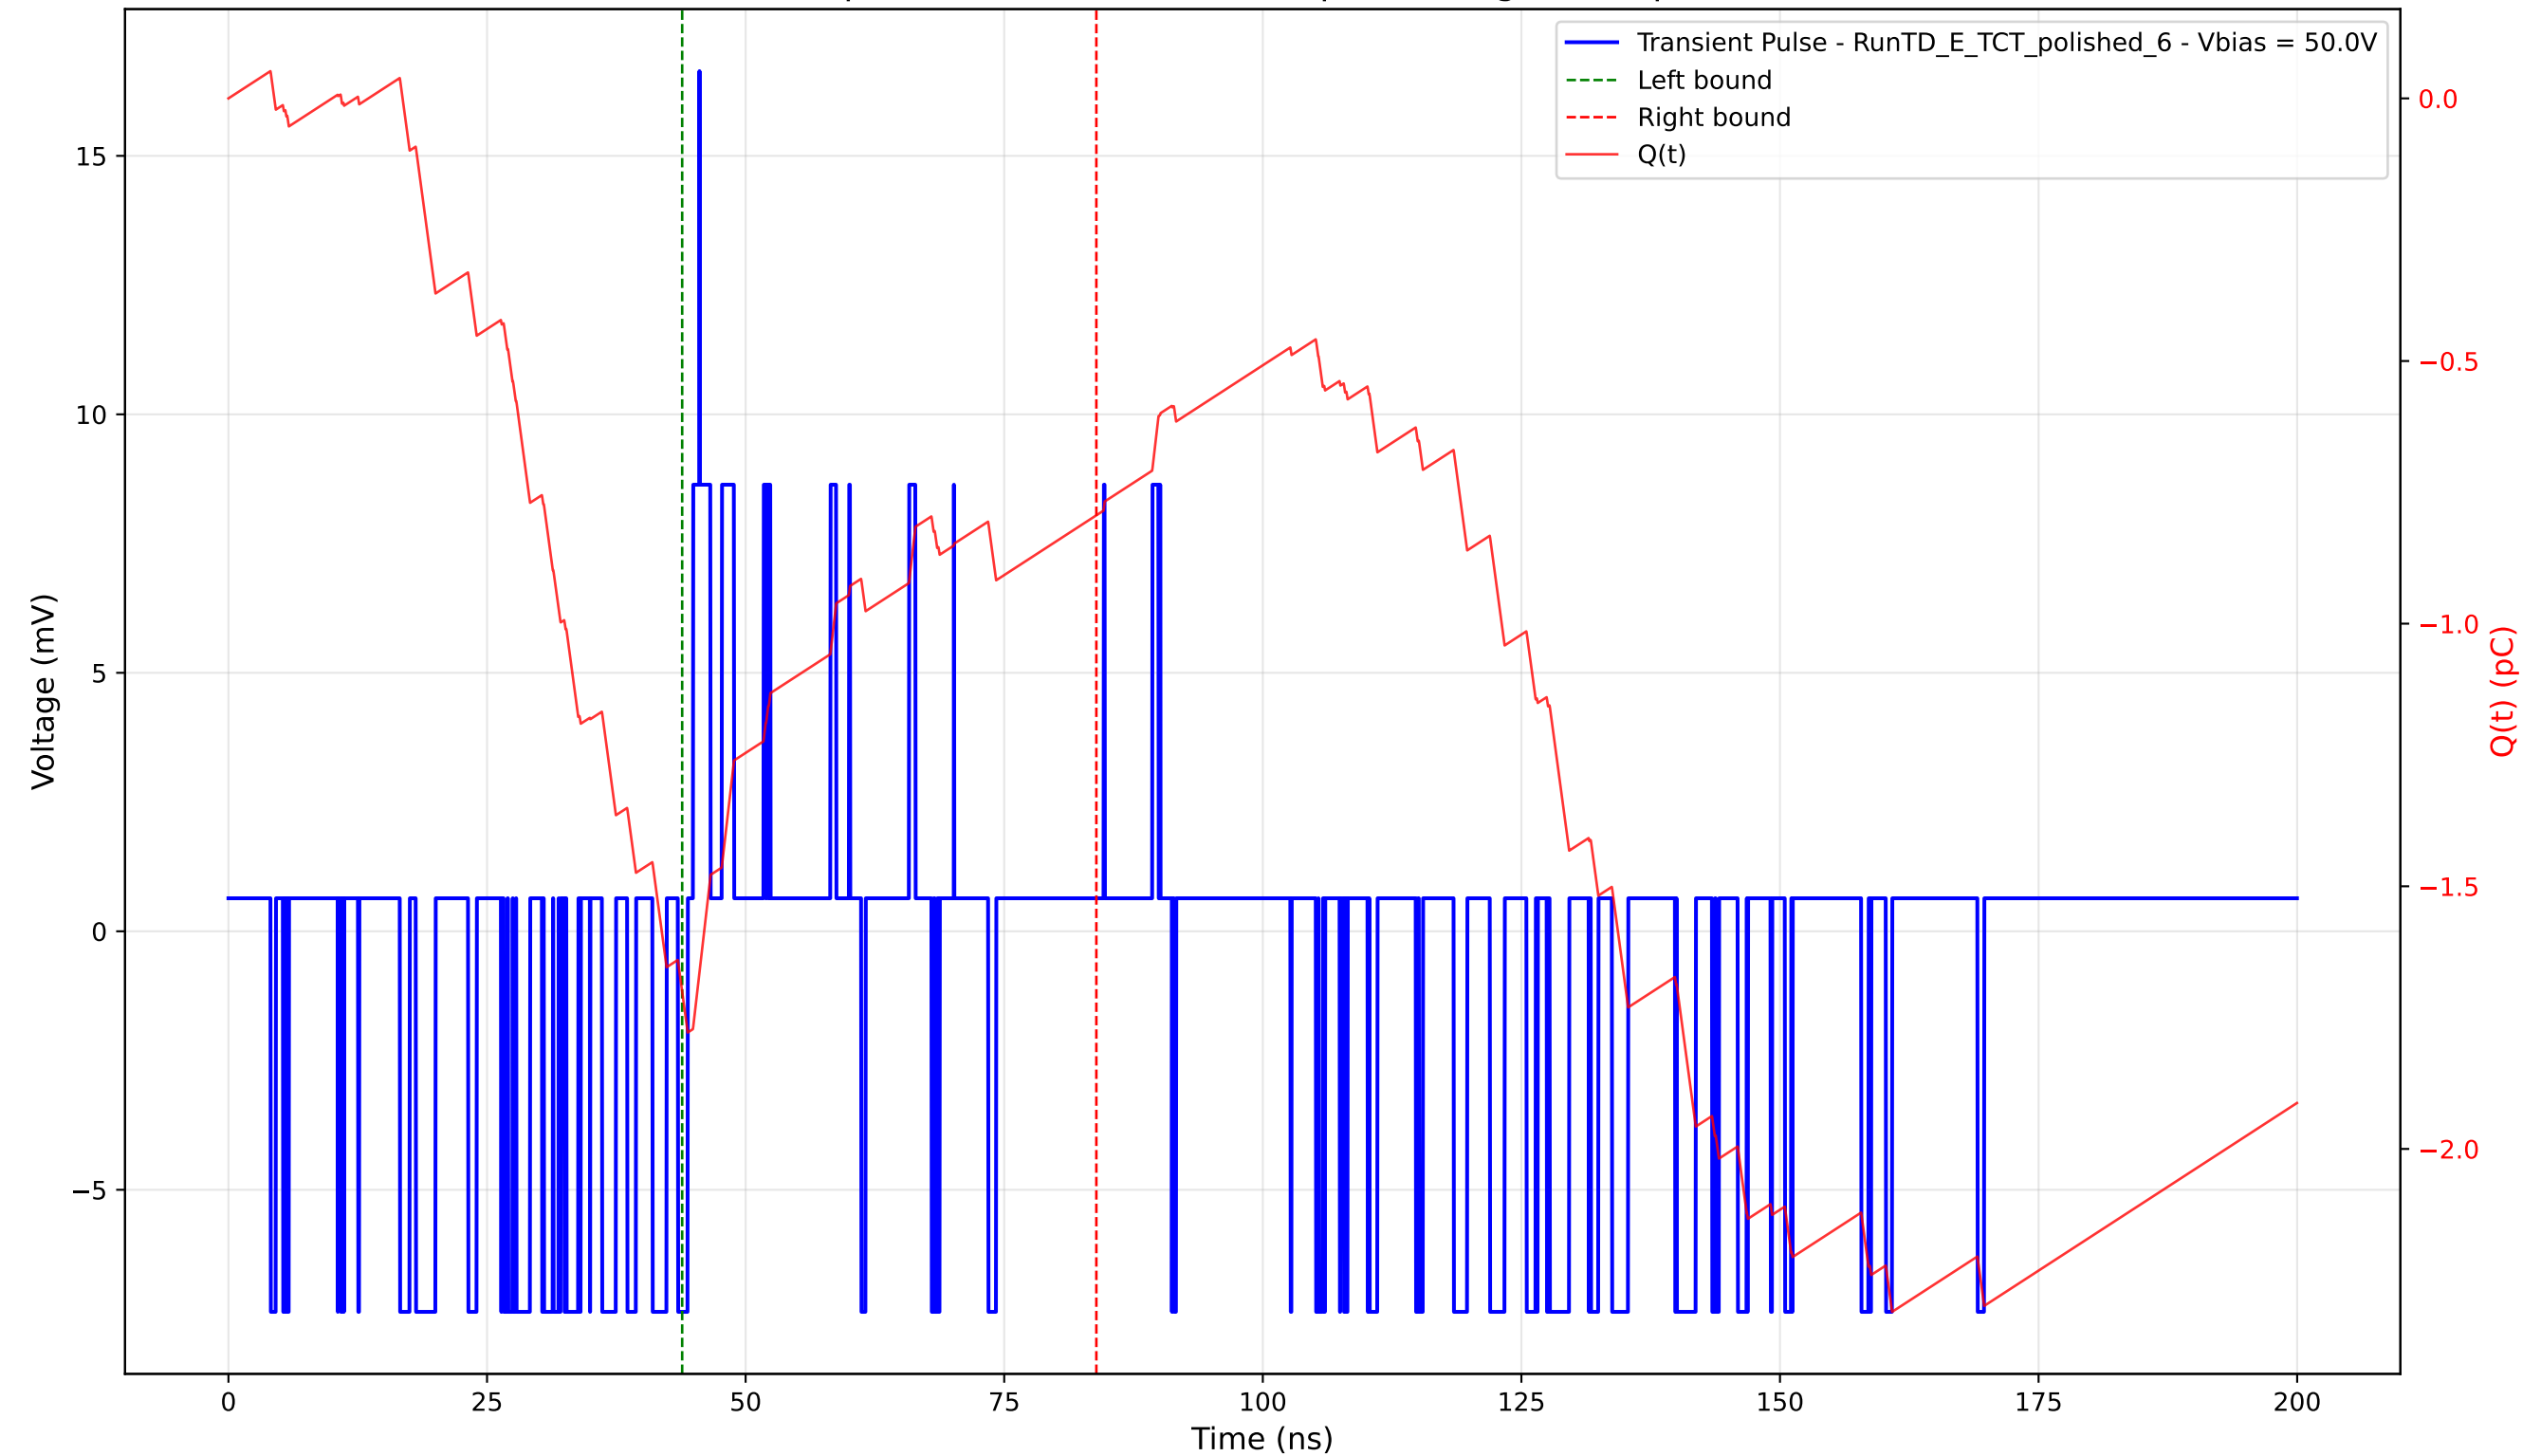


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 0.68 pC - Rise Time: 0.90 ns

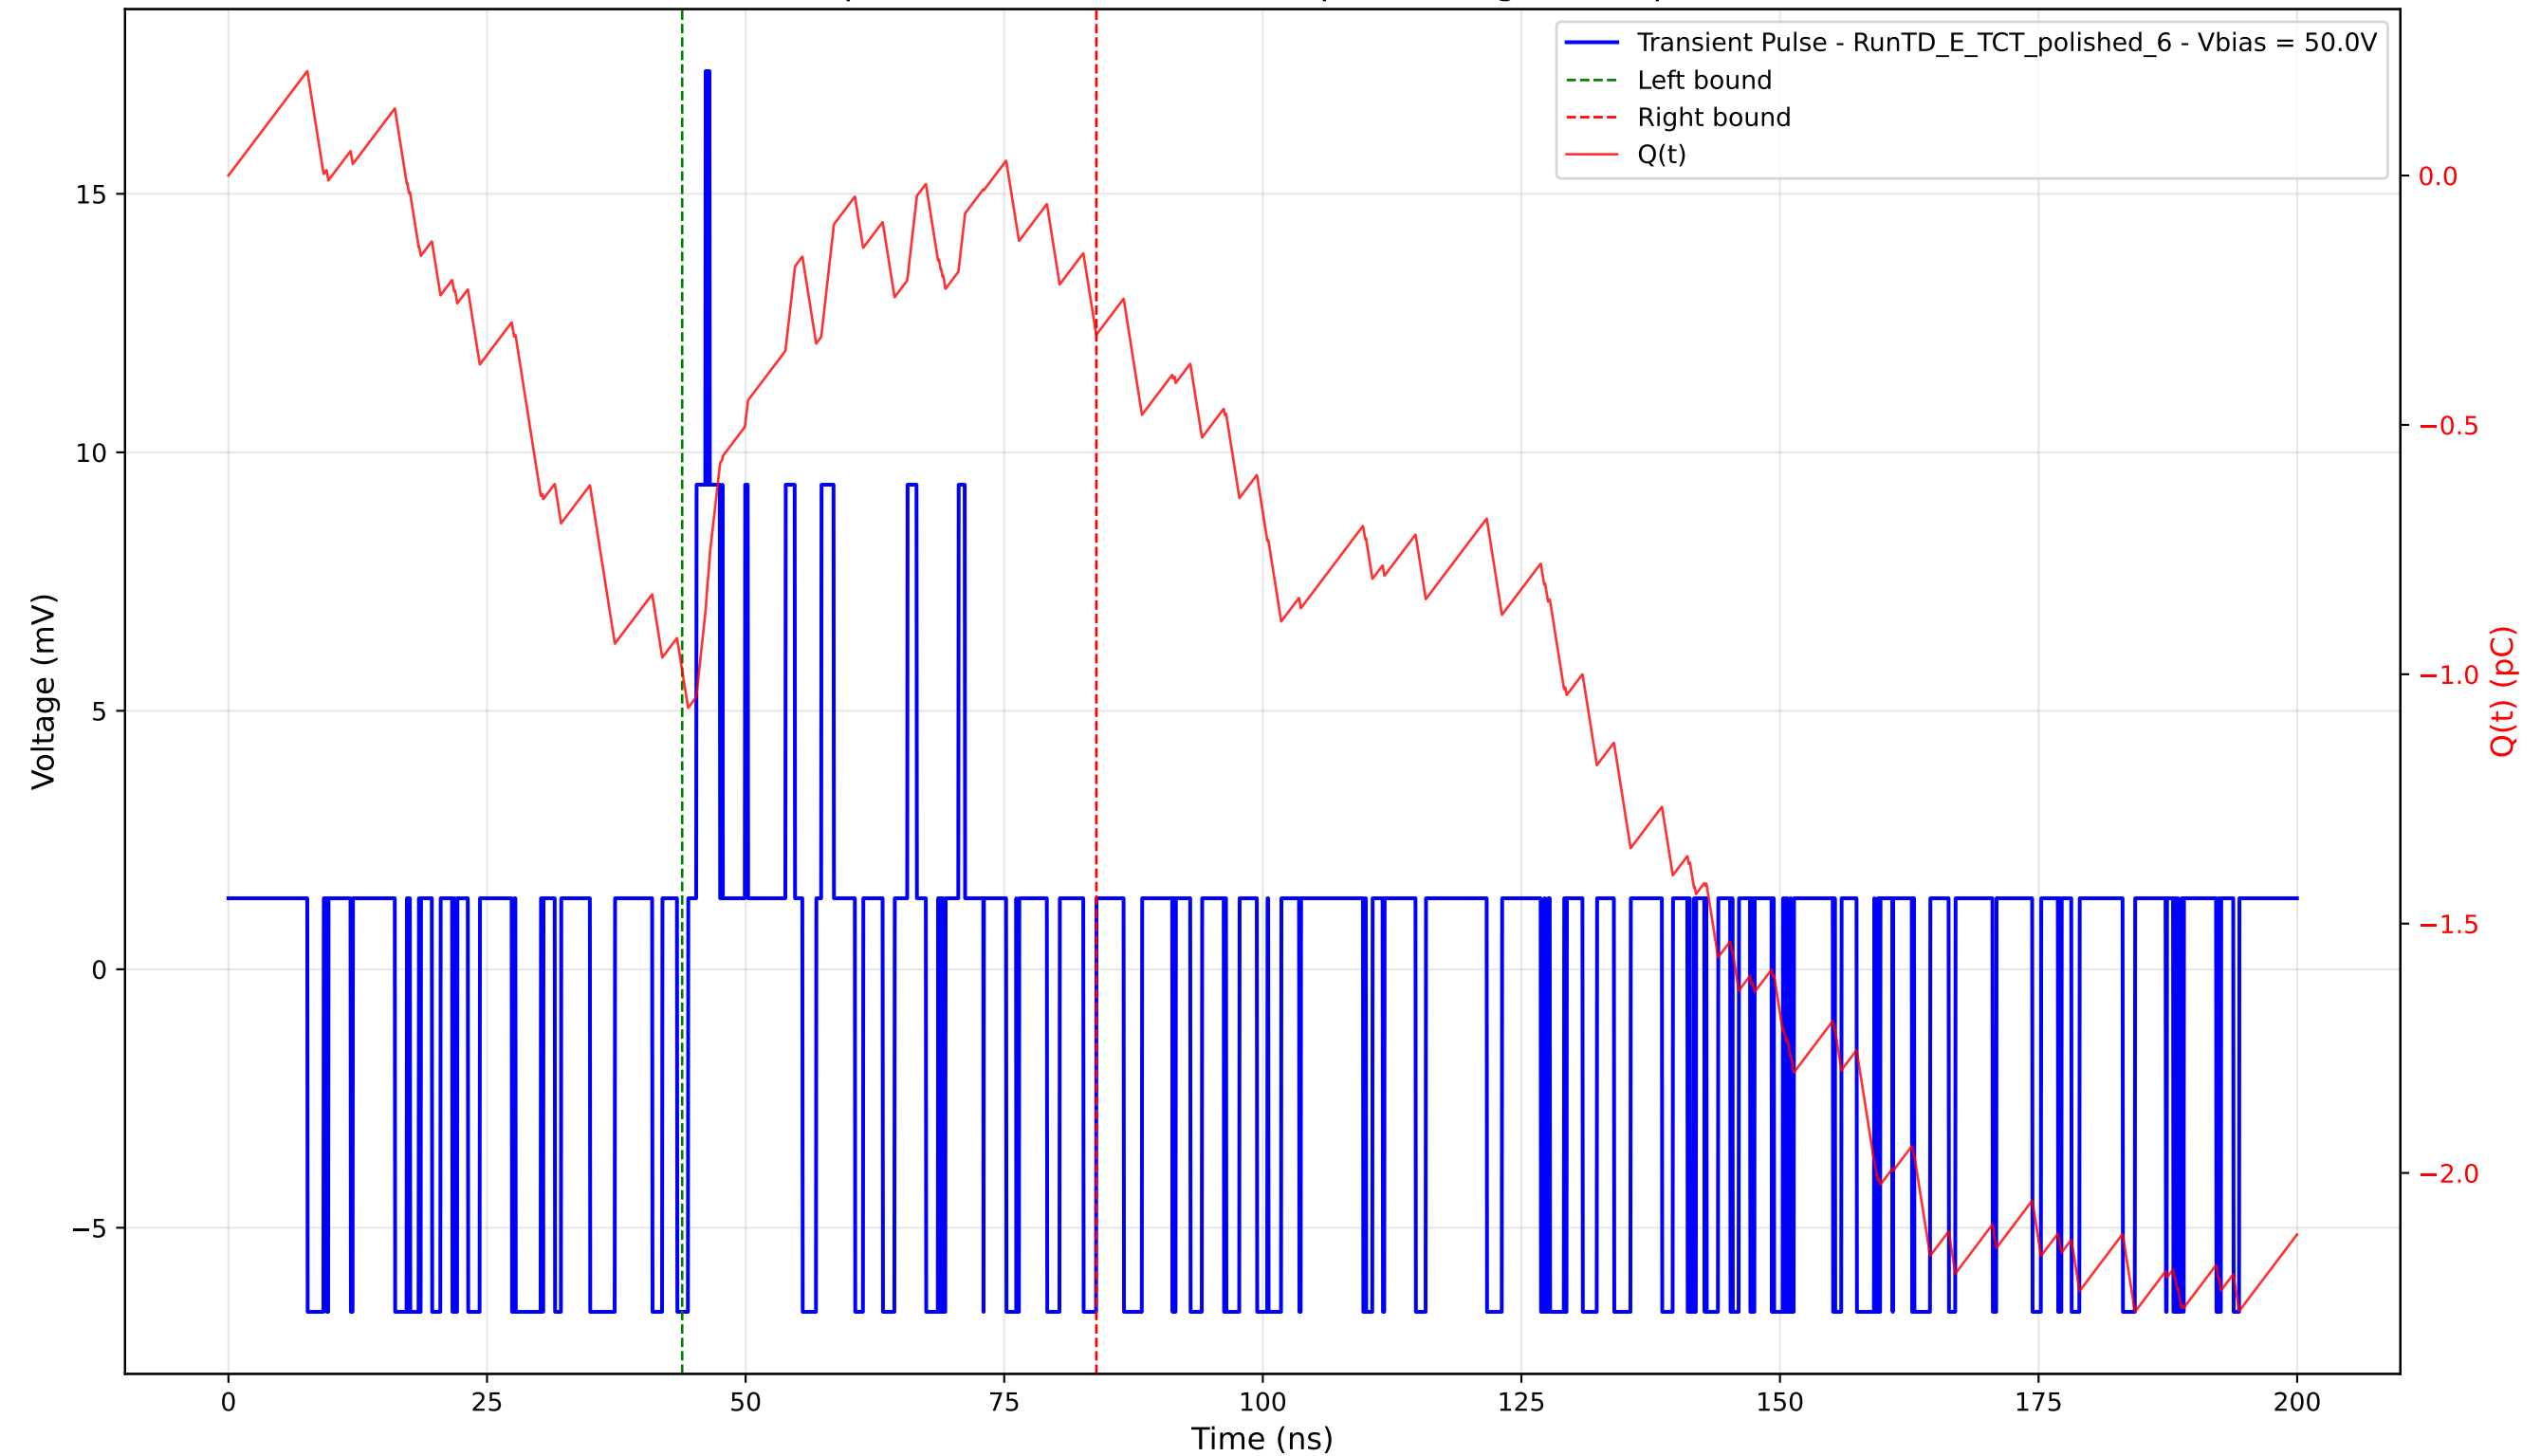


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 1.56 pC - Rise Time: 0.48 ns

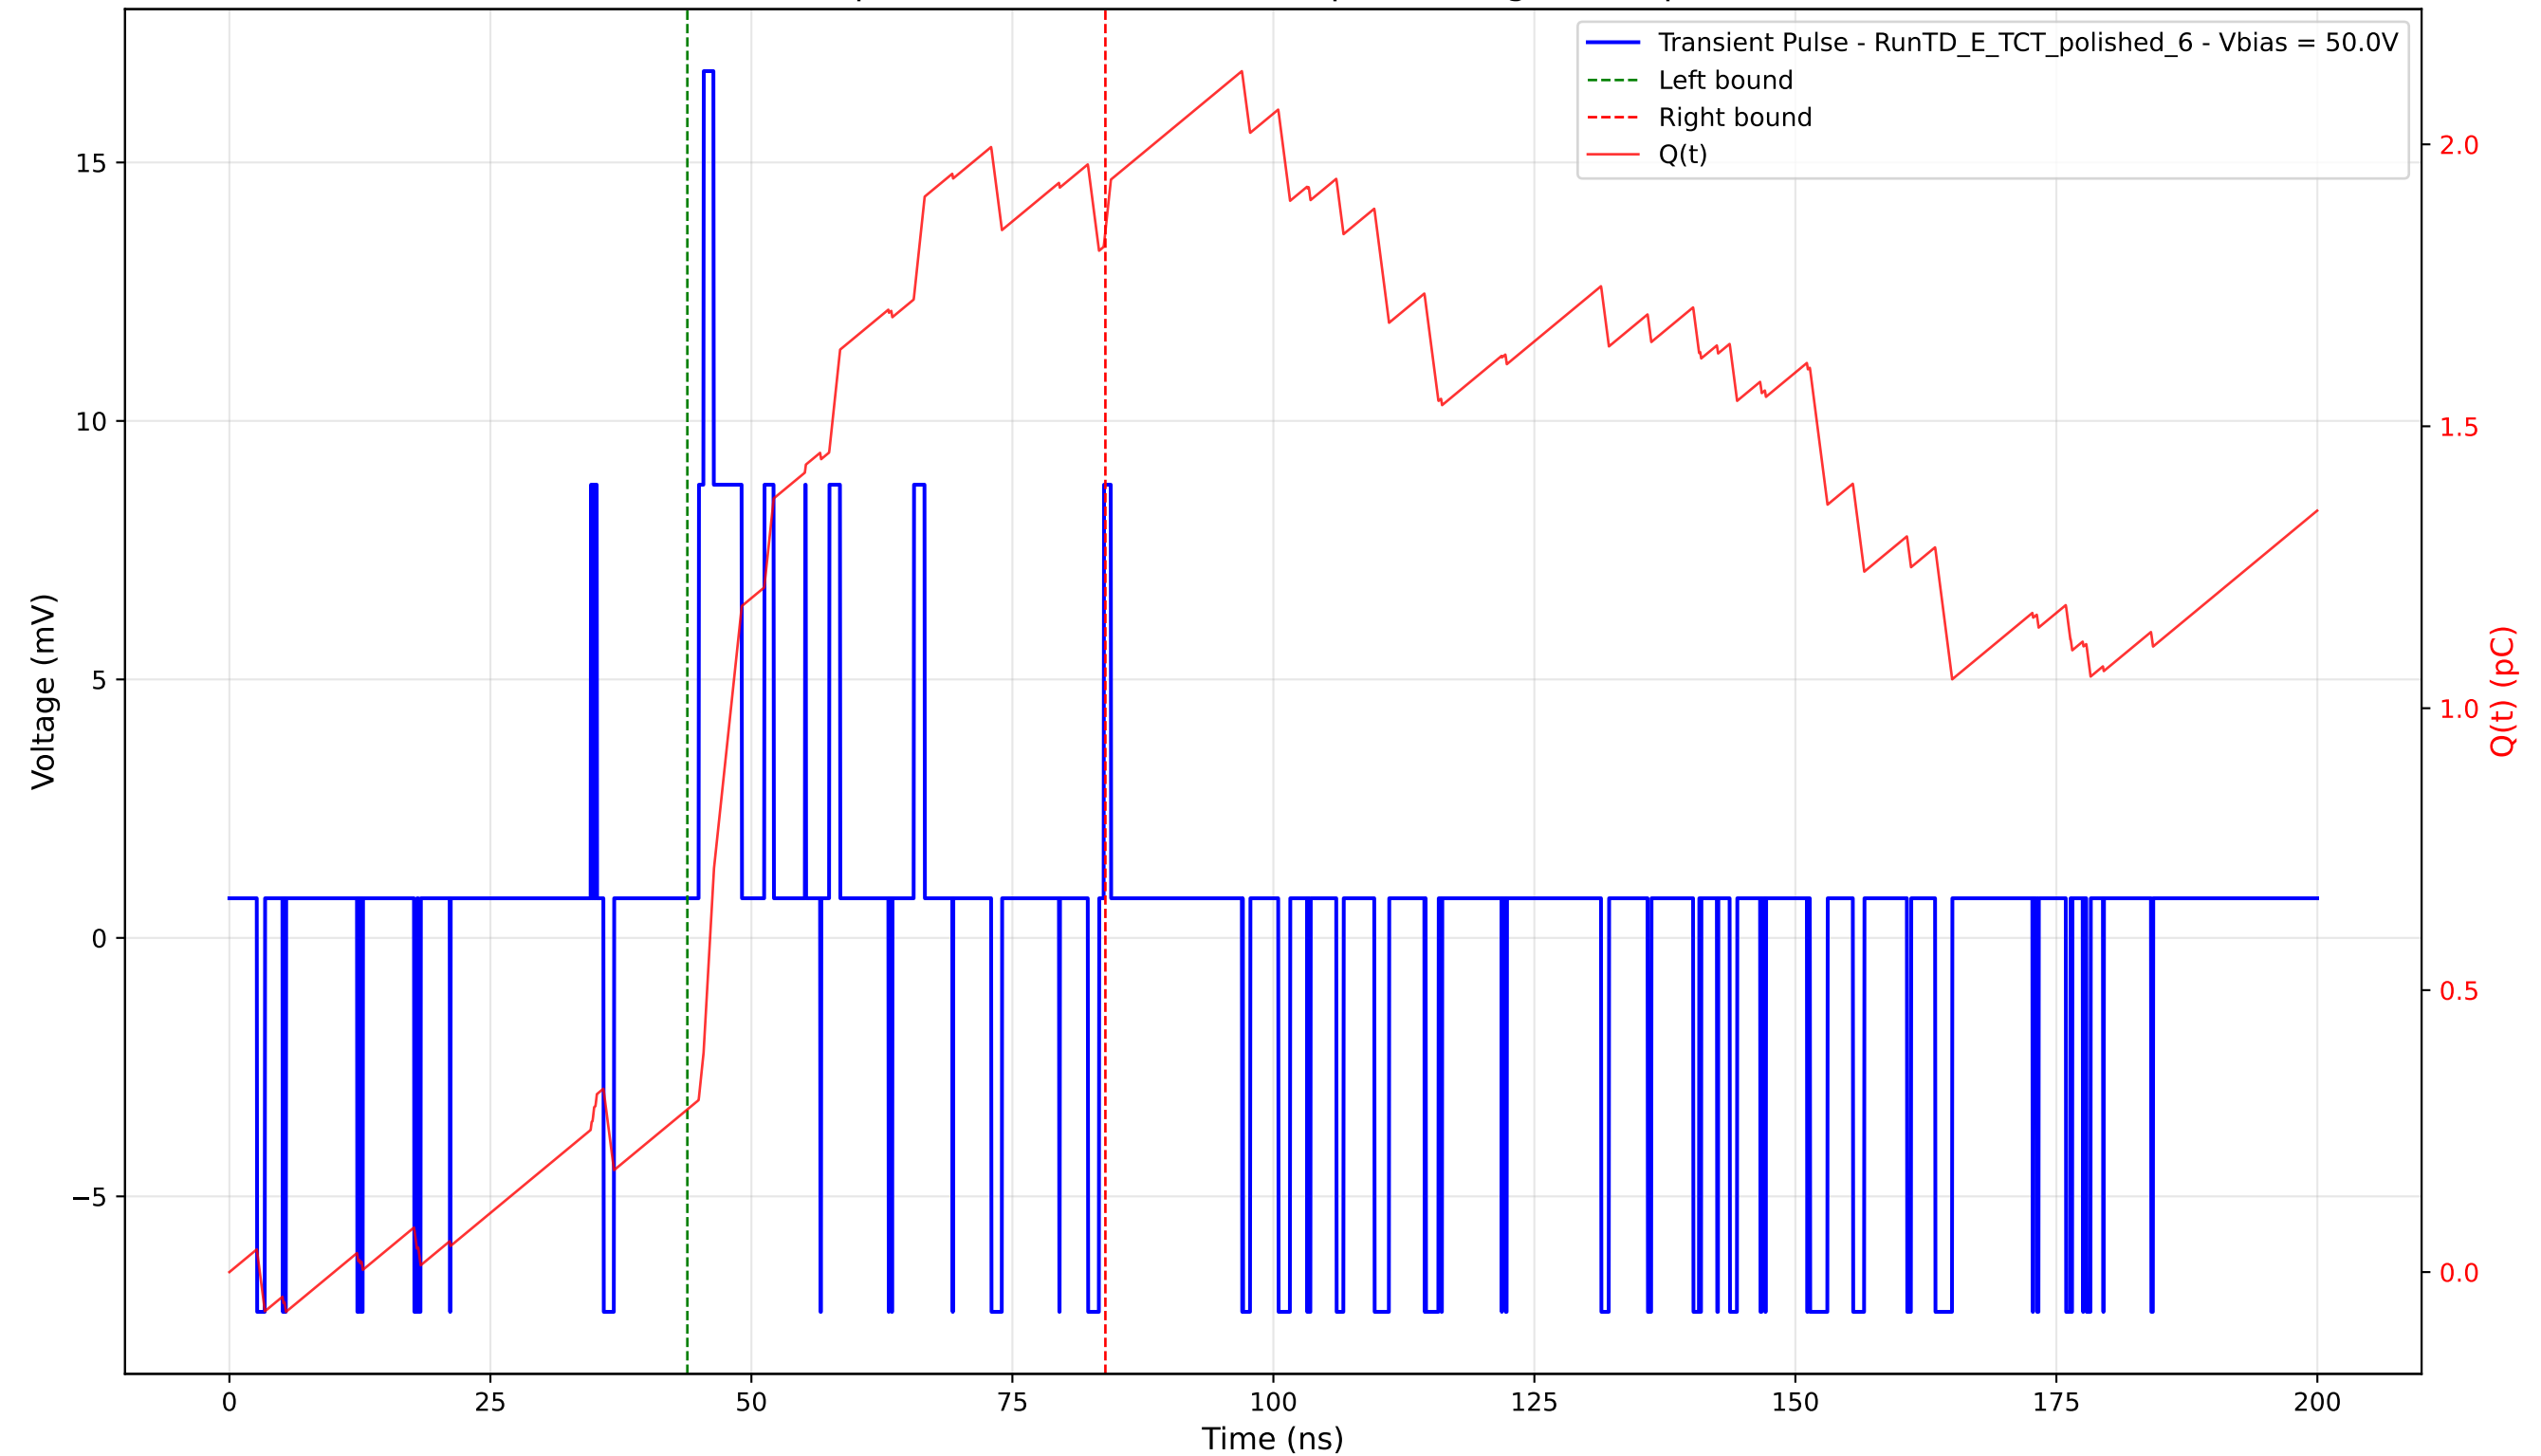


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 0.59 pC - Rise Time: 0.76 ns

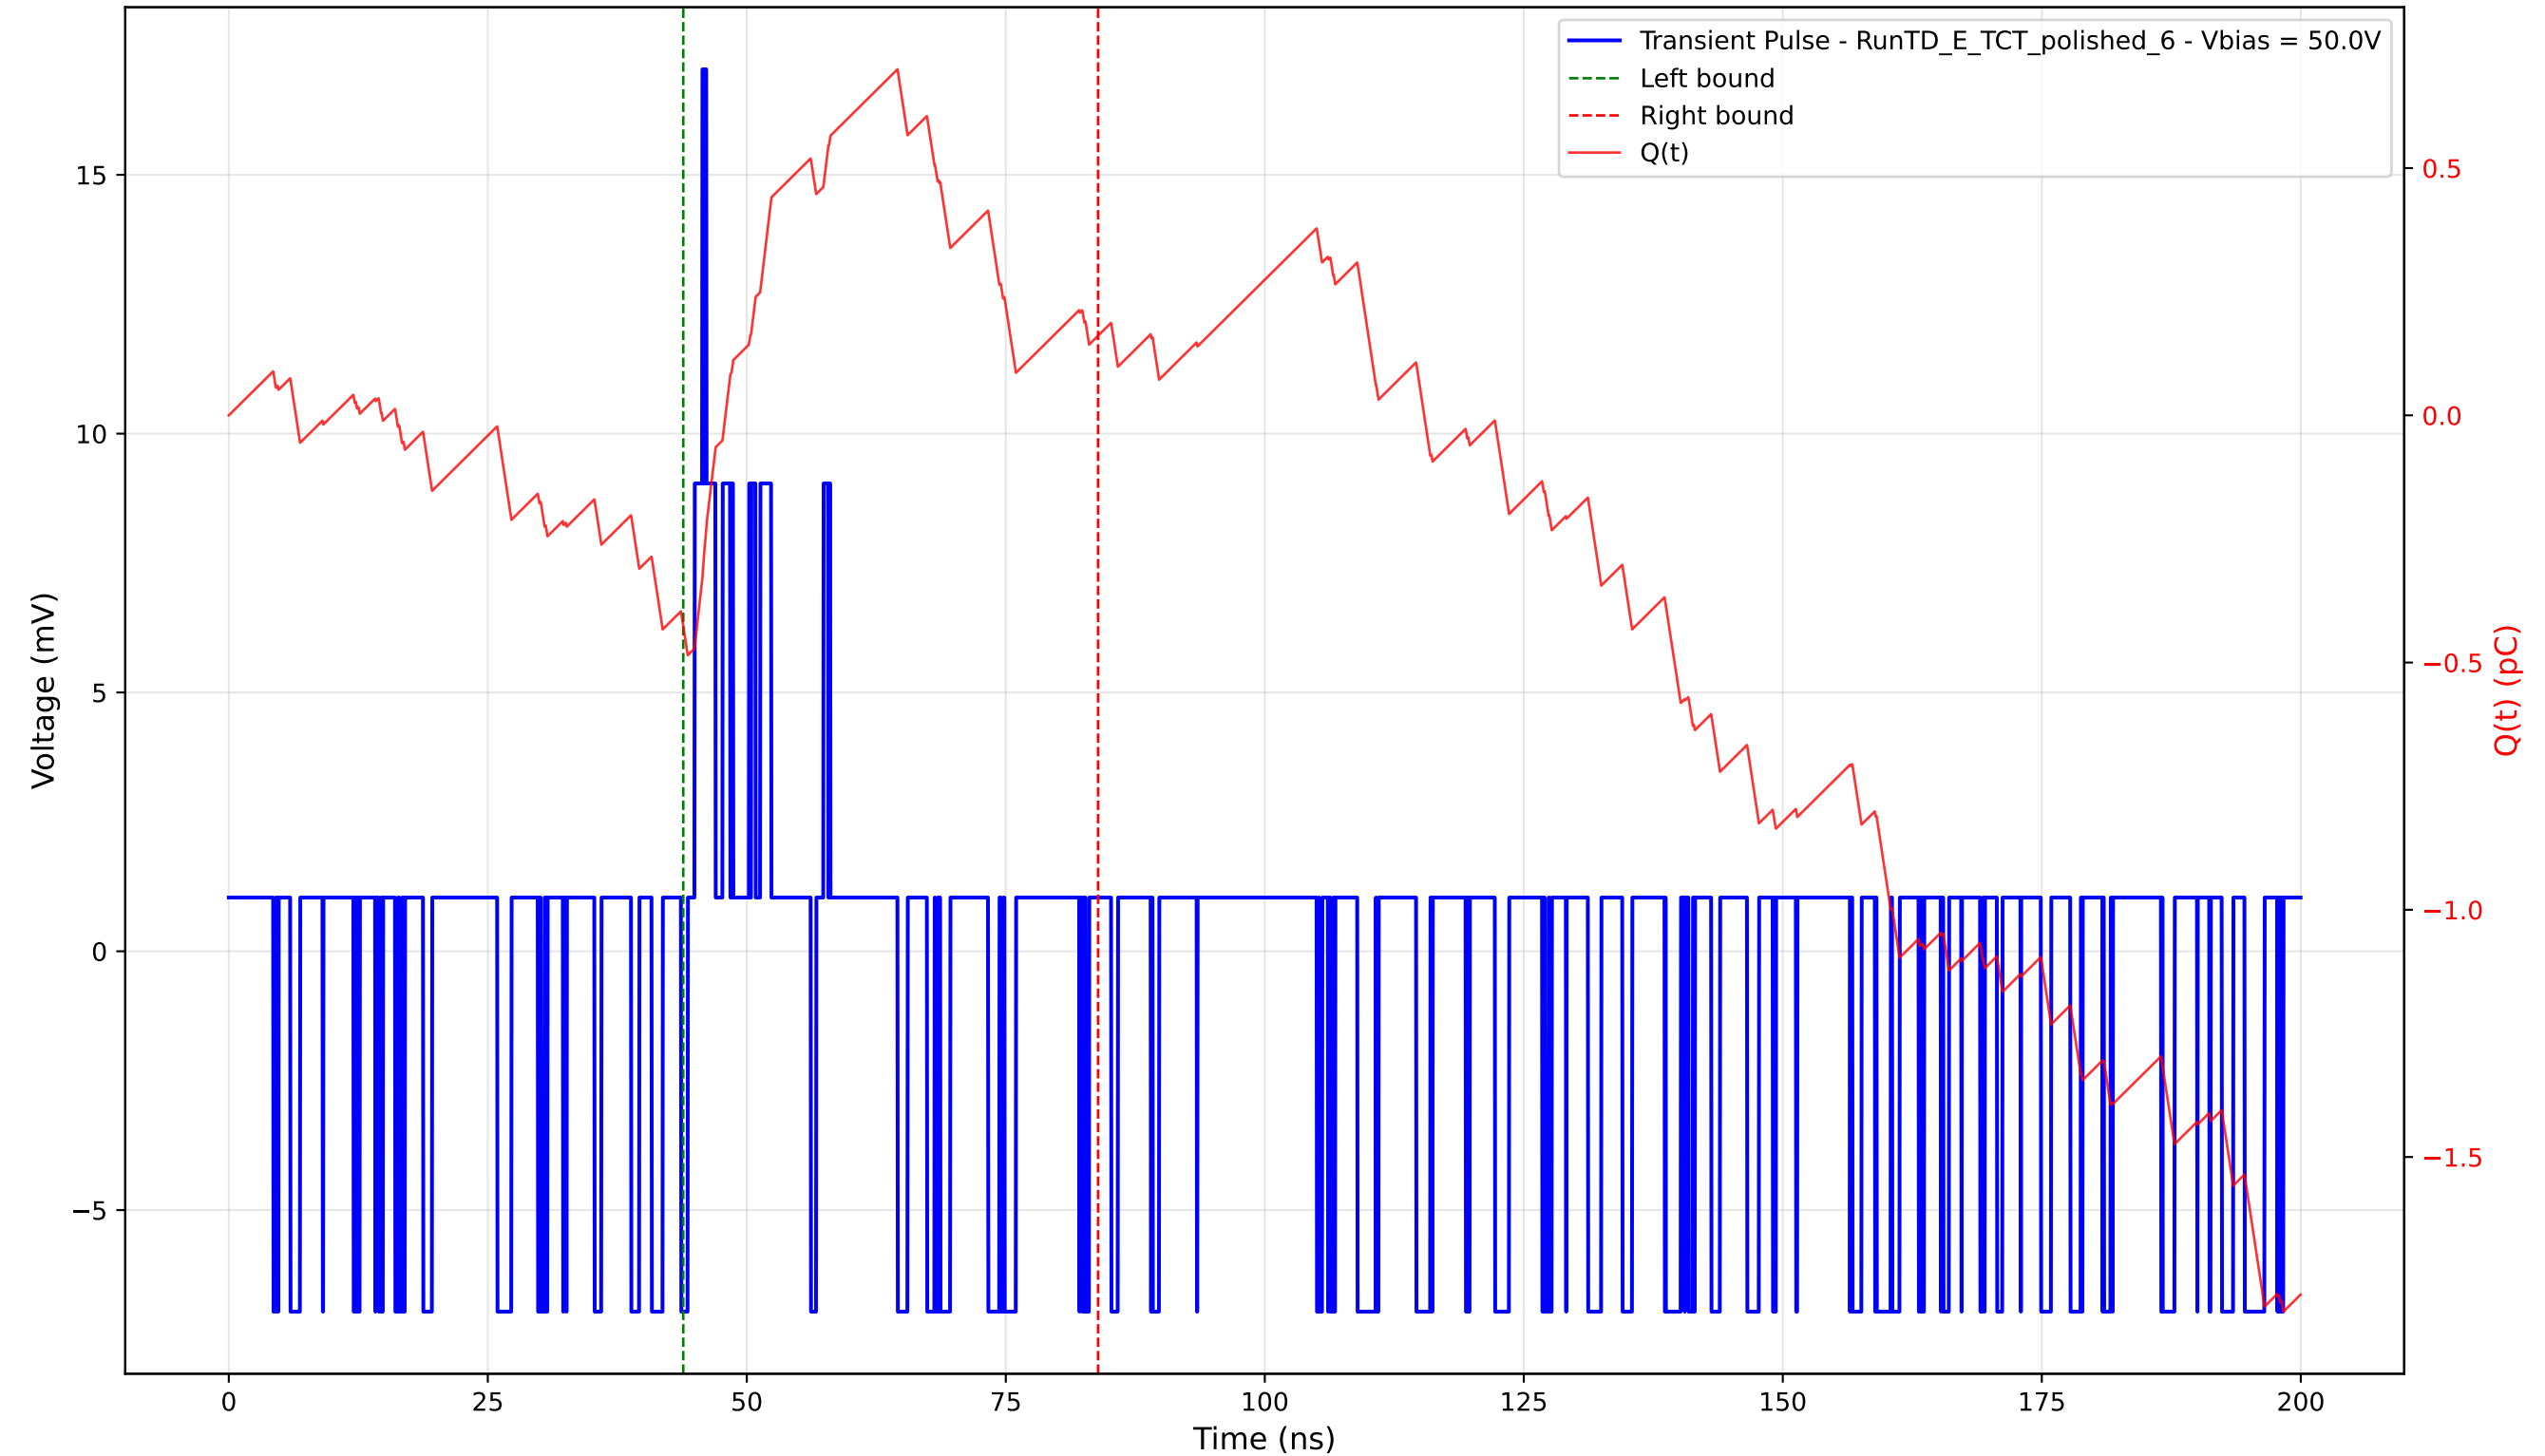


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 0.51 pC - Rise Time: 0.02 ns

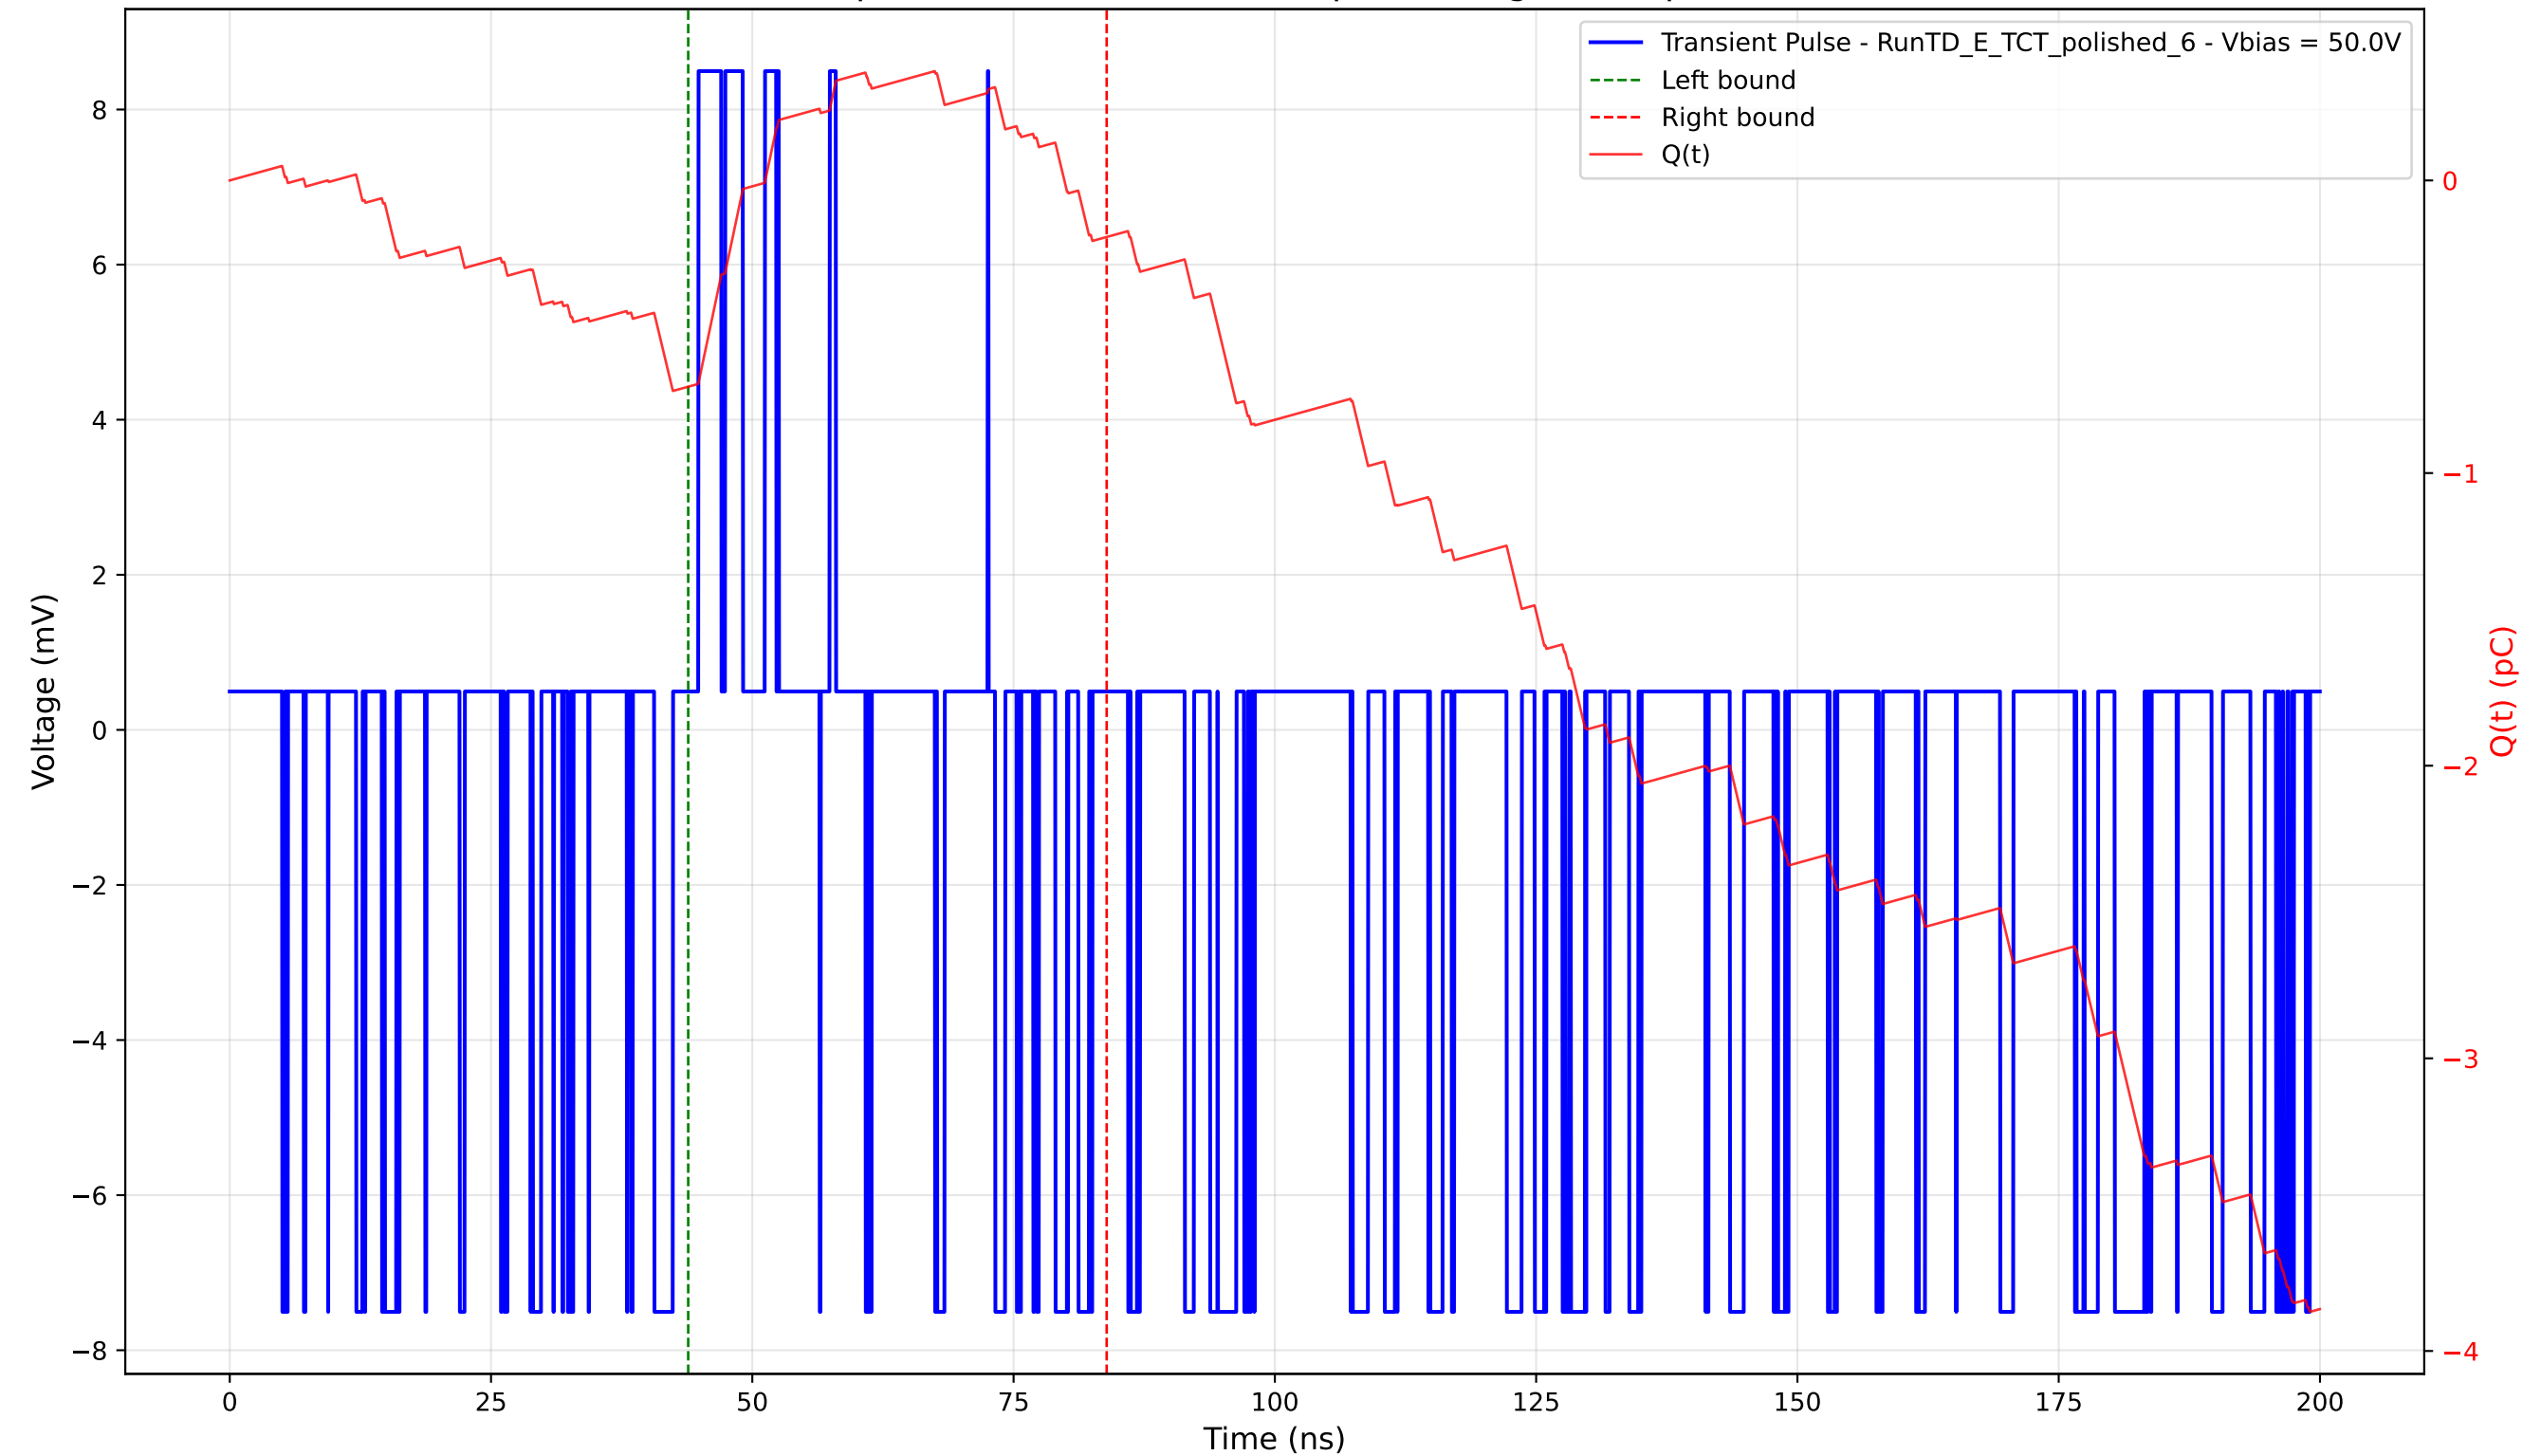


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 1.20 pC - Rise Time: 0.64 ns

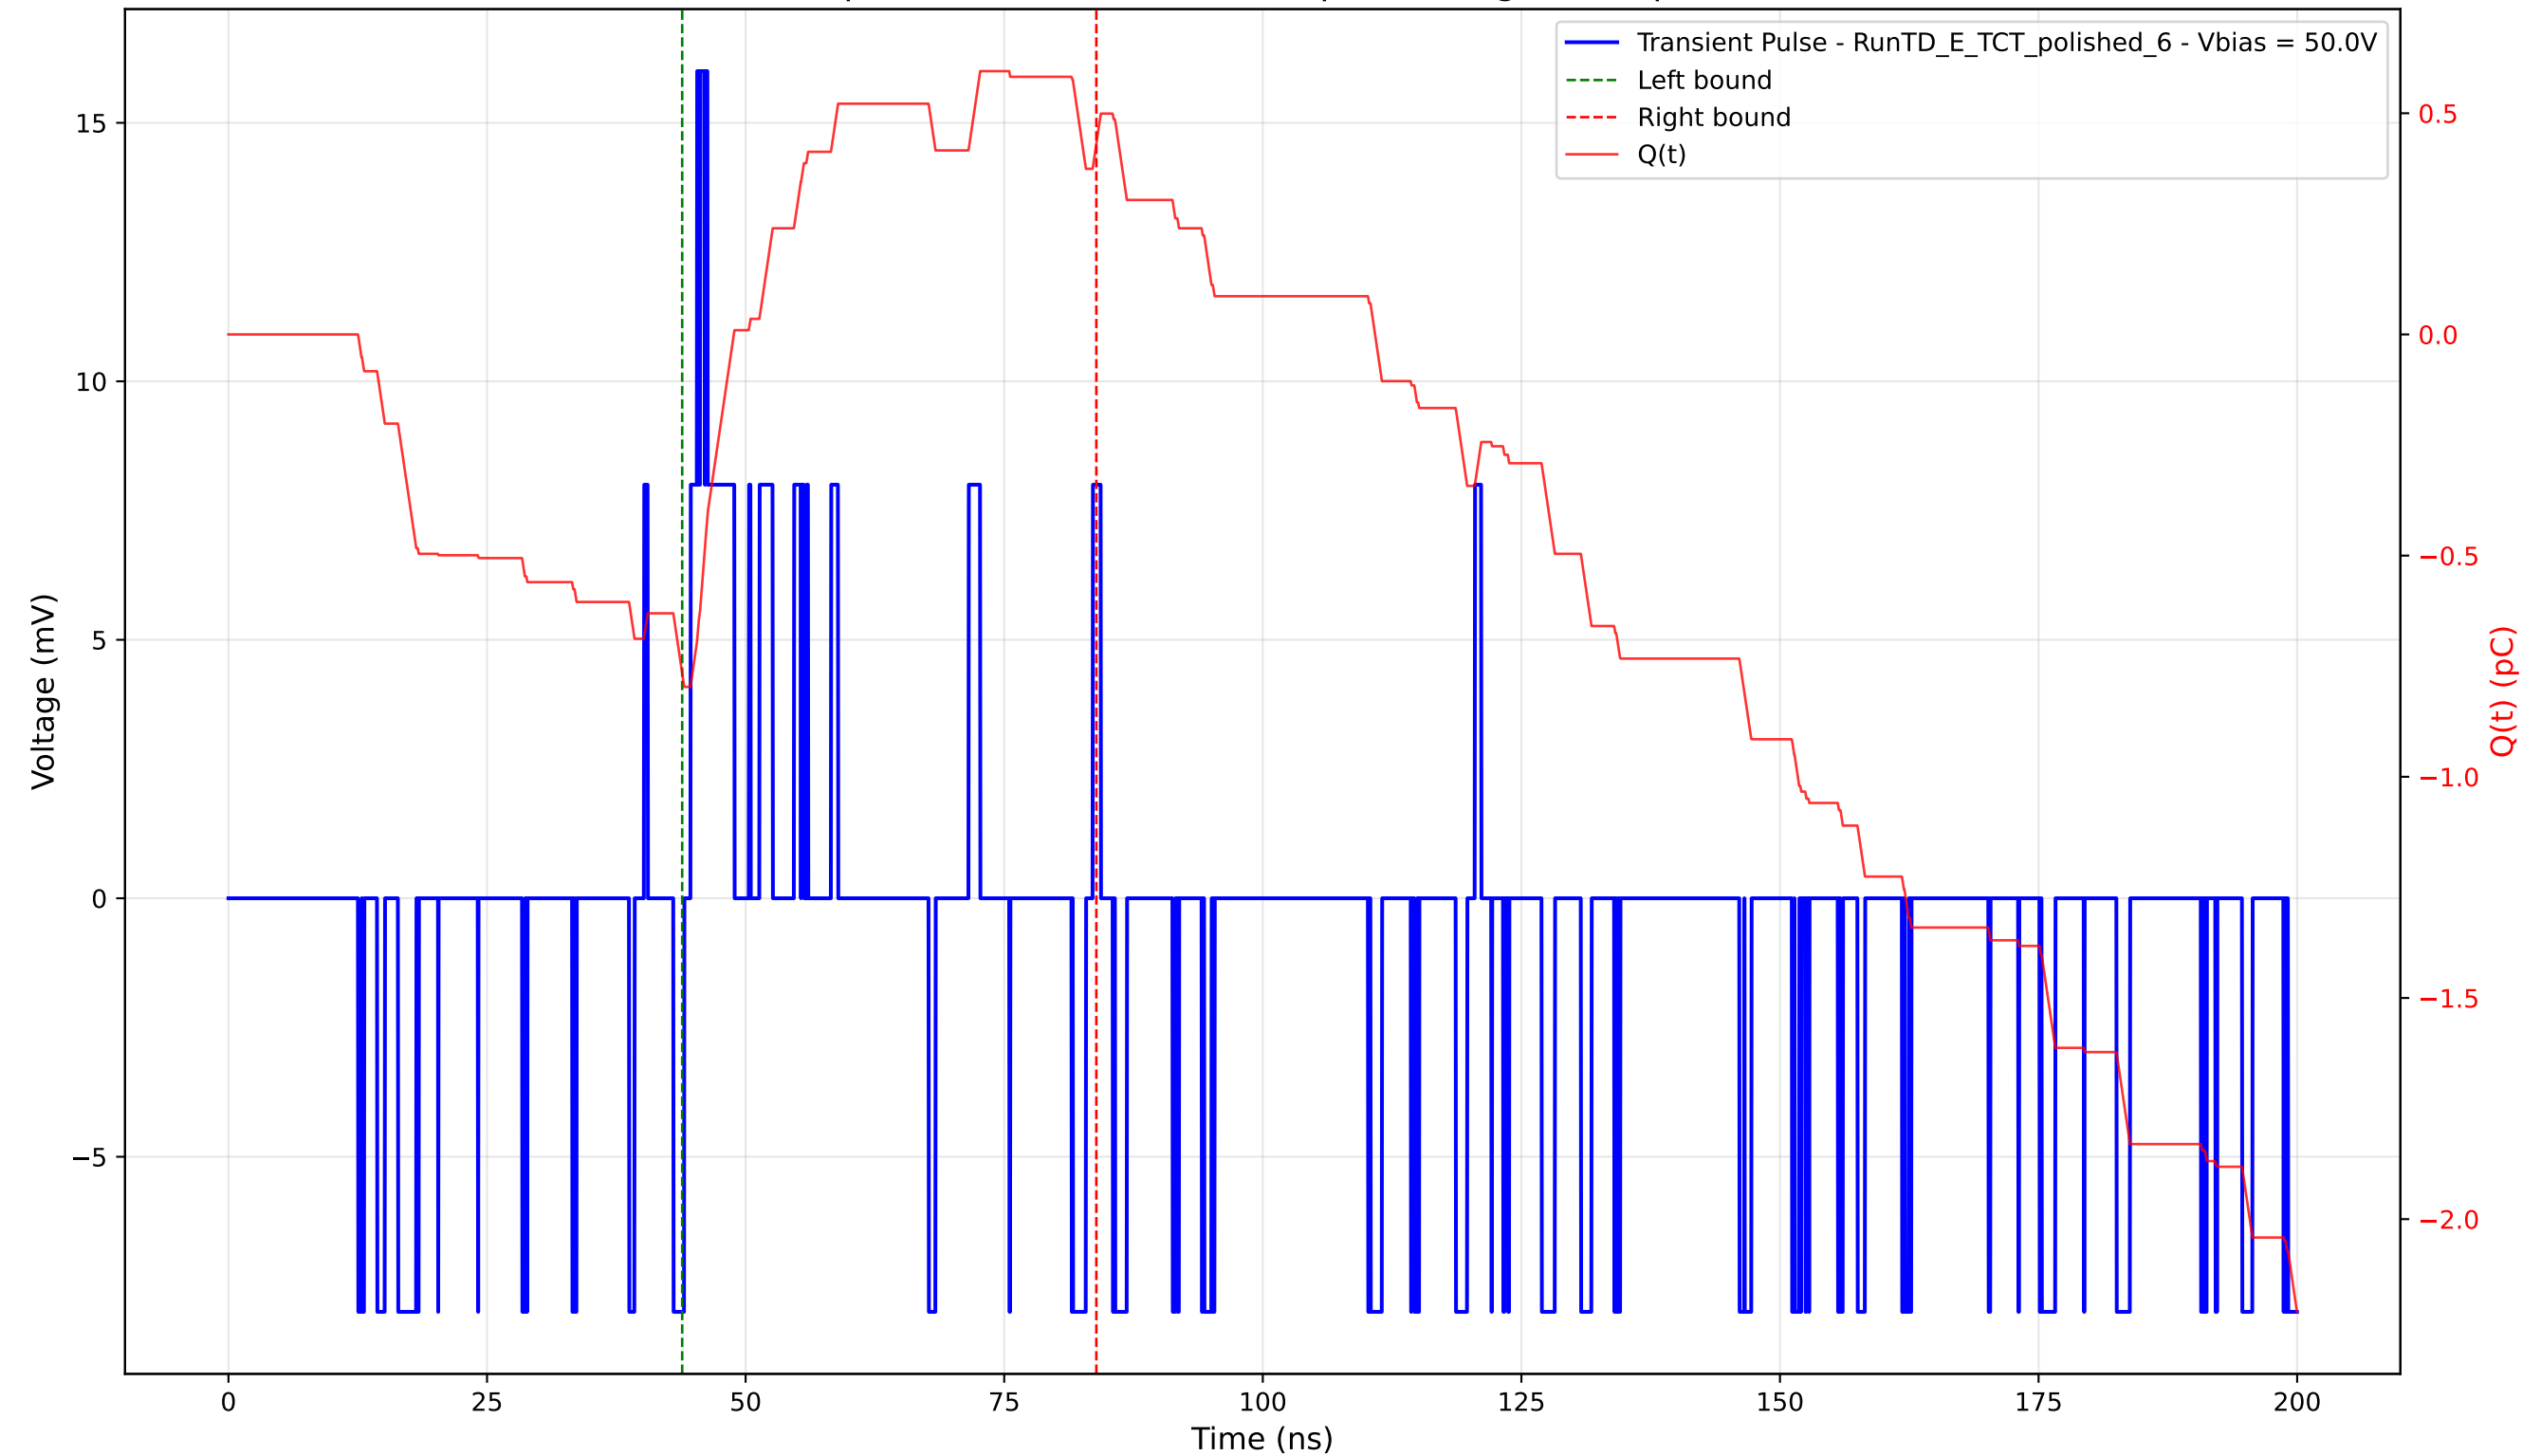


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 1.98 pC - Rise Time: 0.44 ns

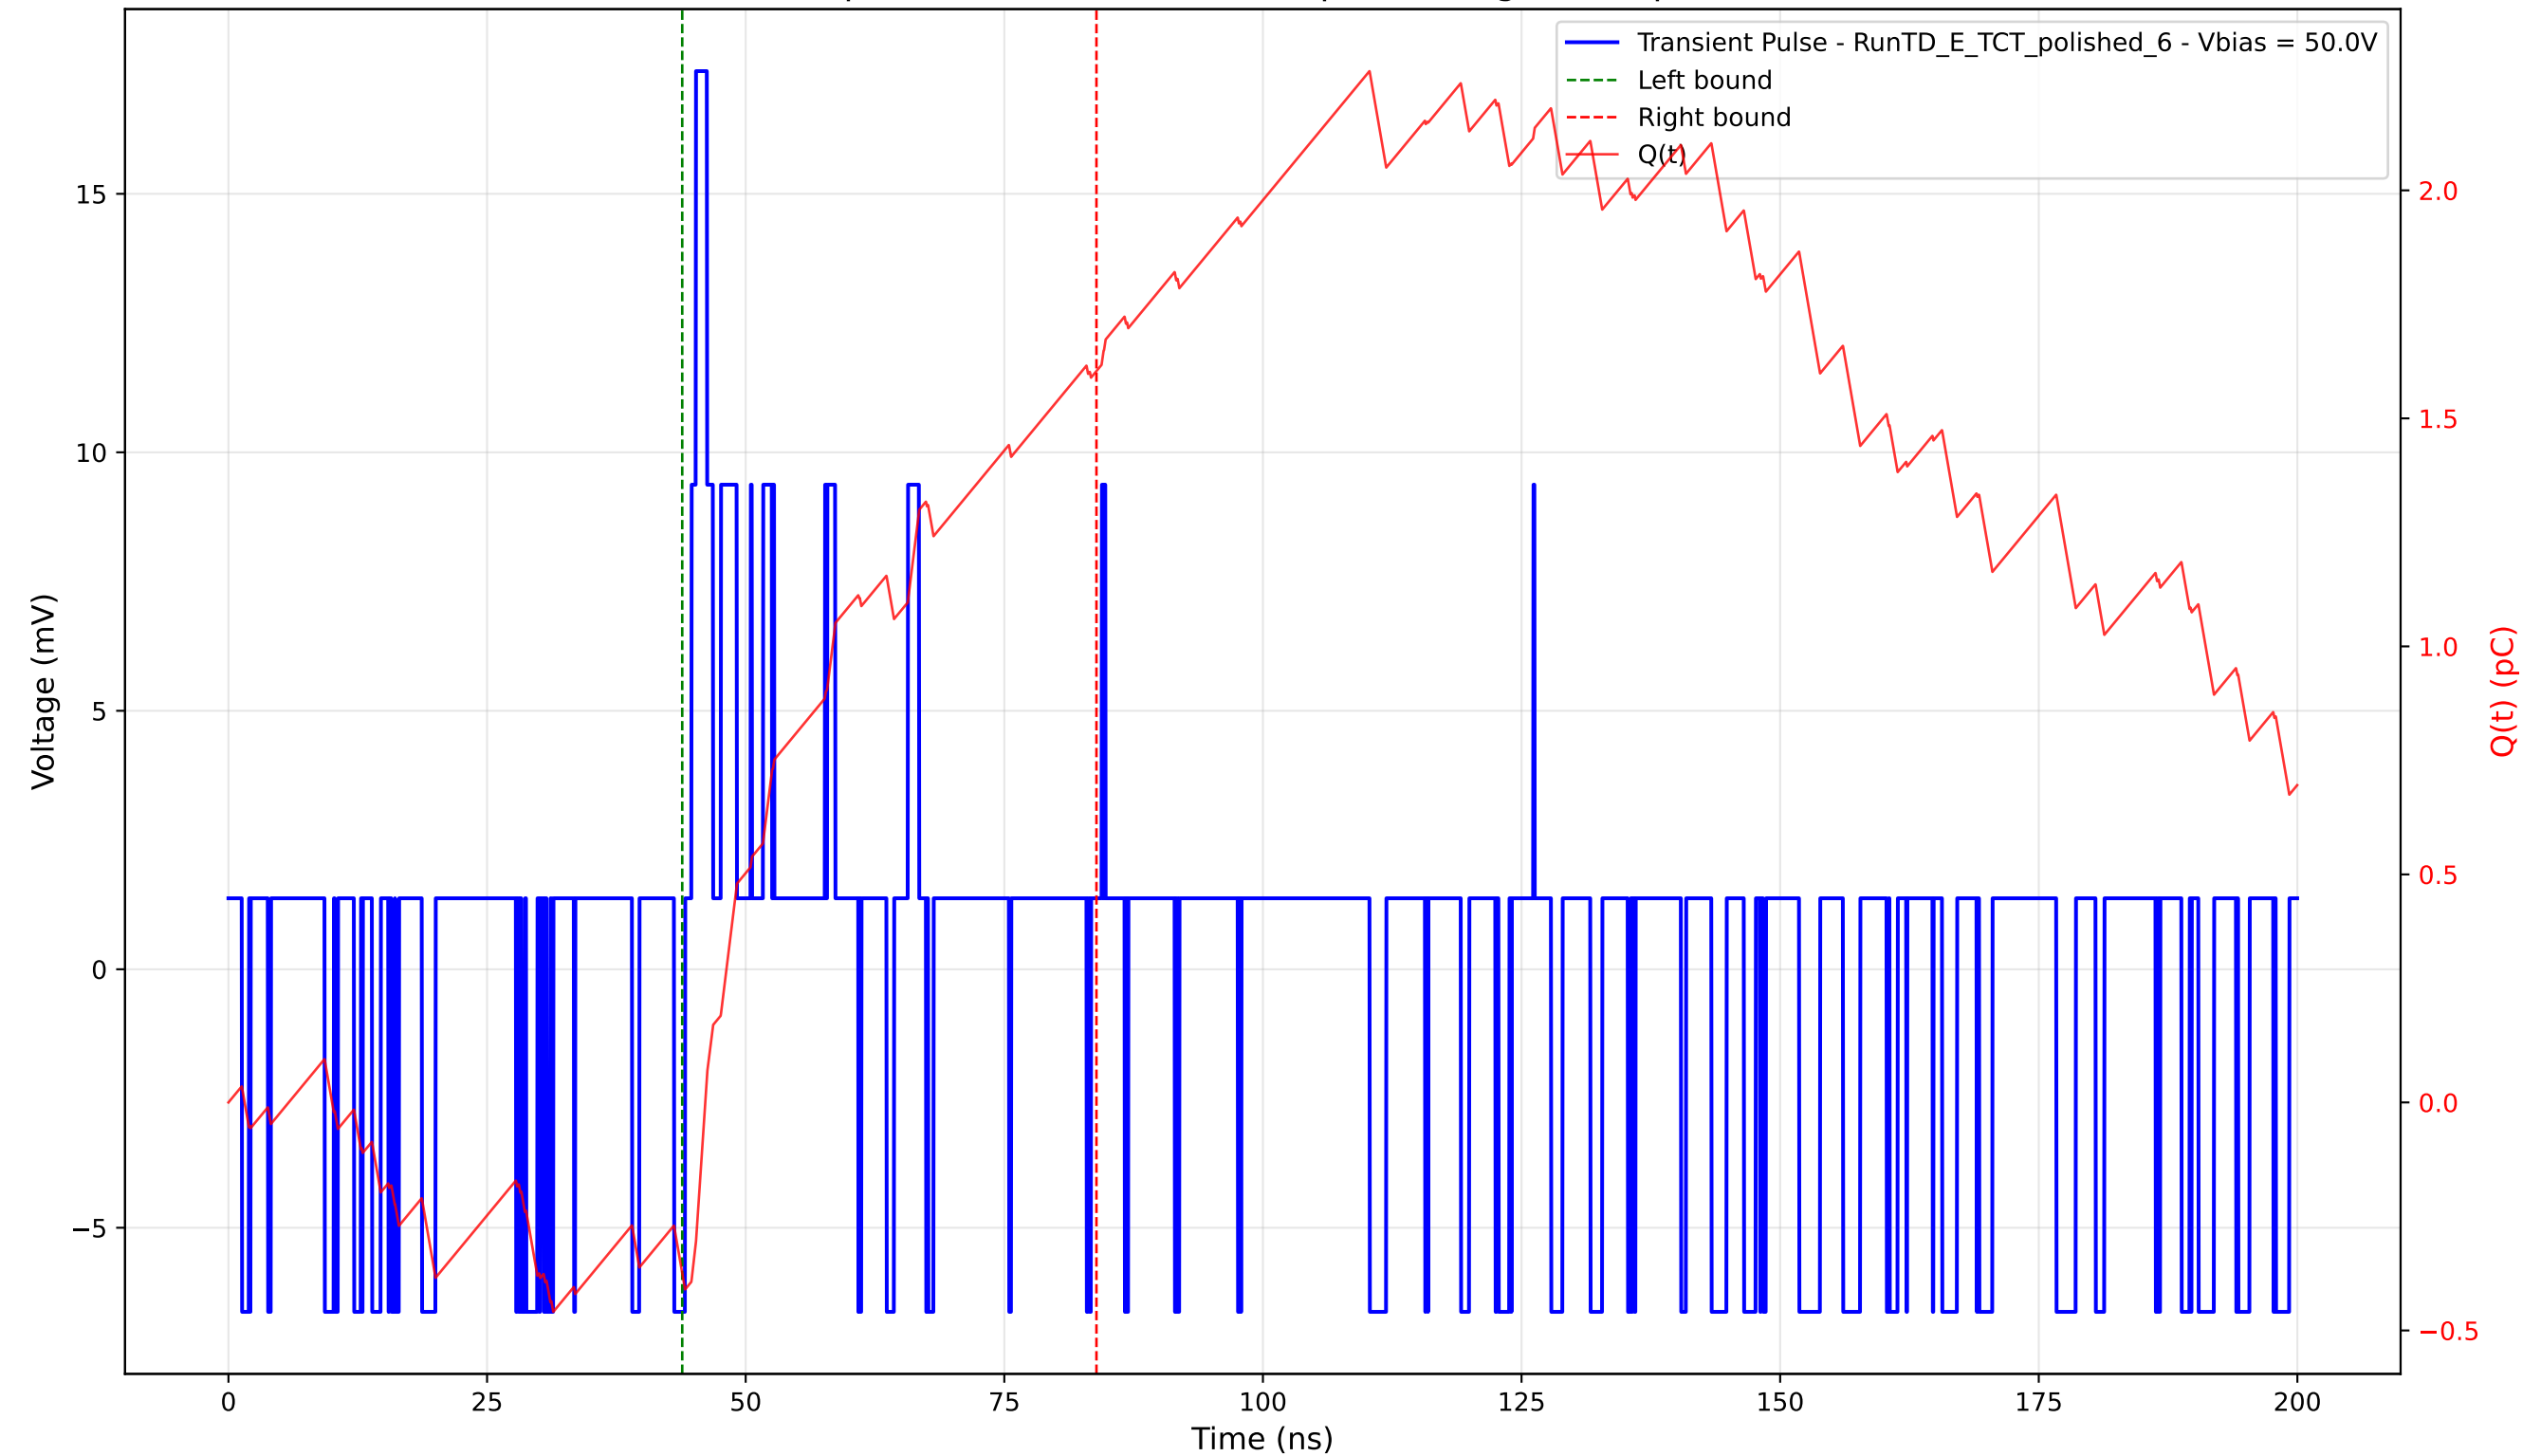


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 1.95 pC - Rise Time: 0.46 ns

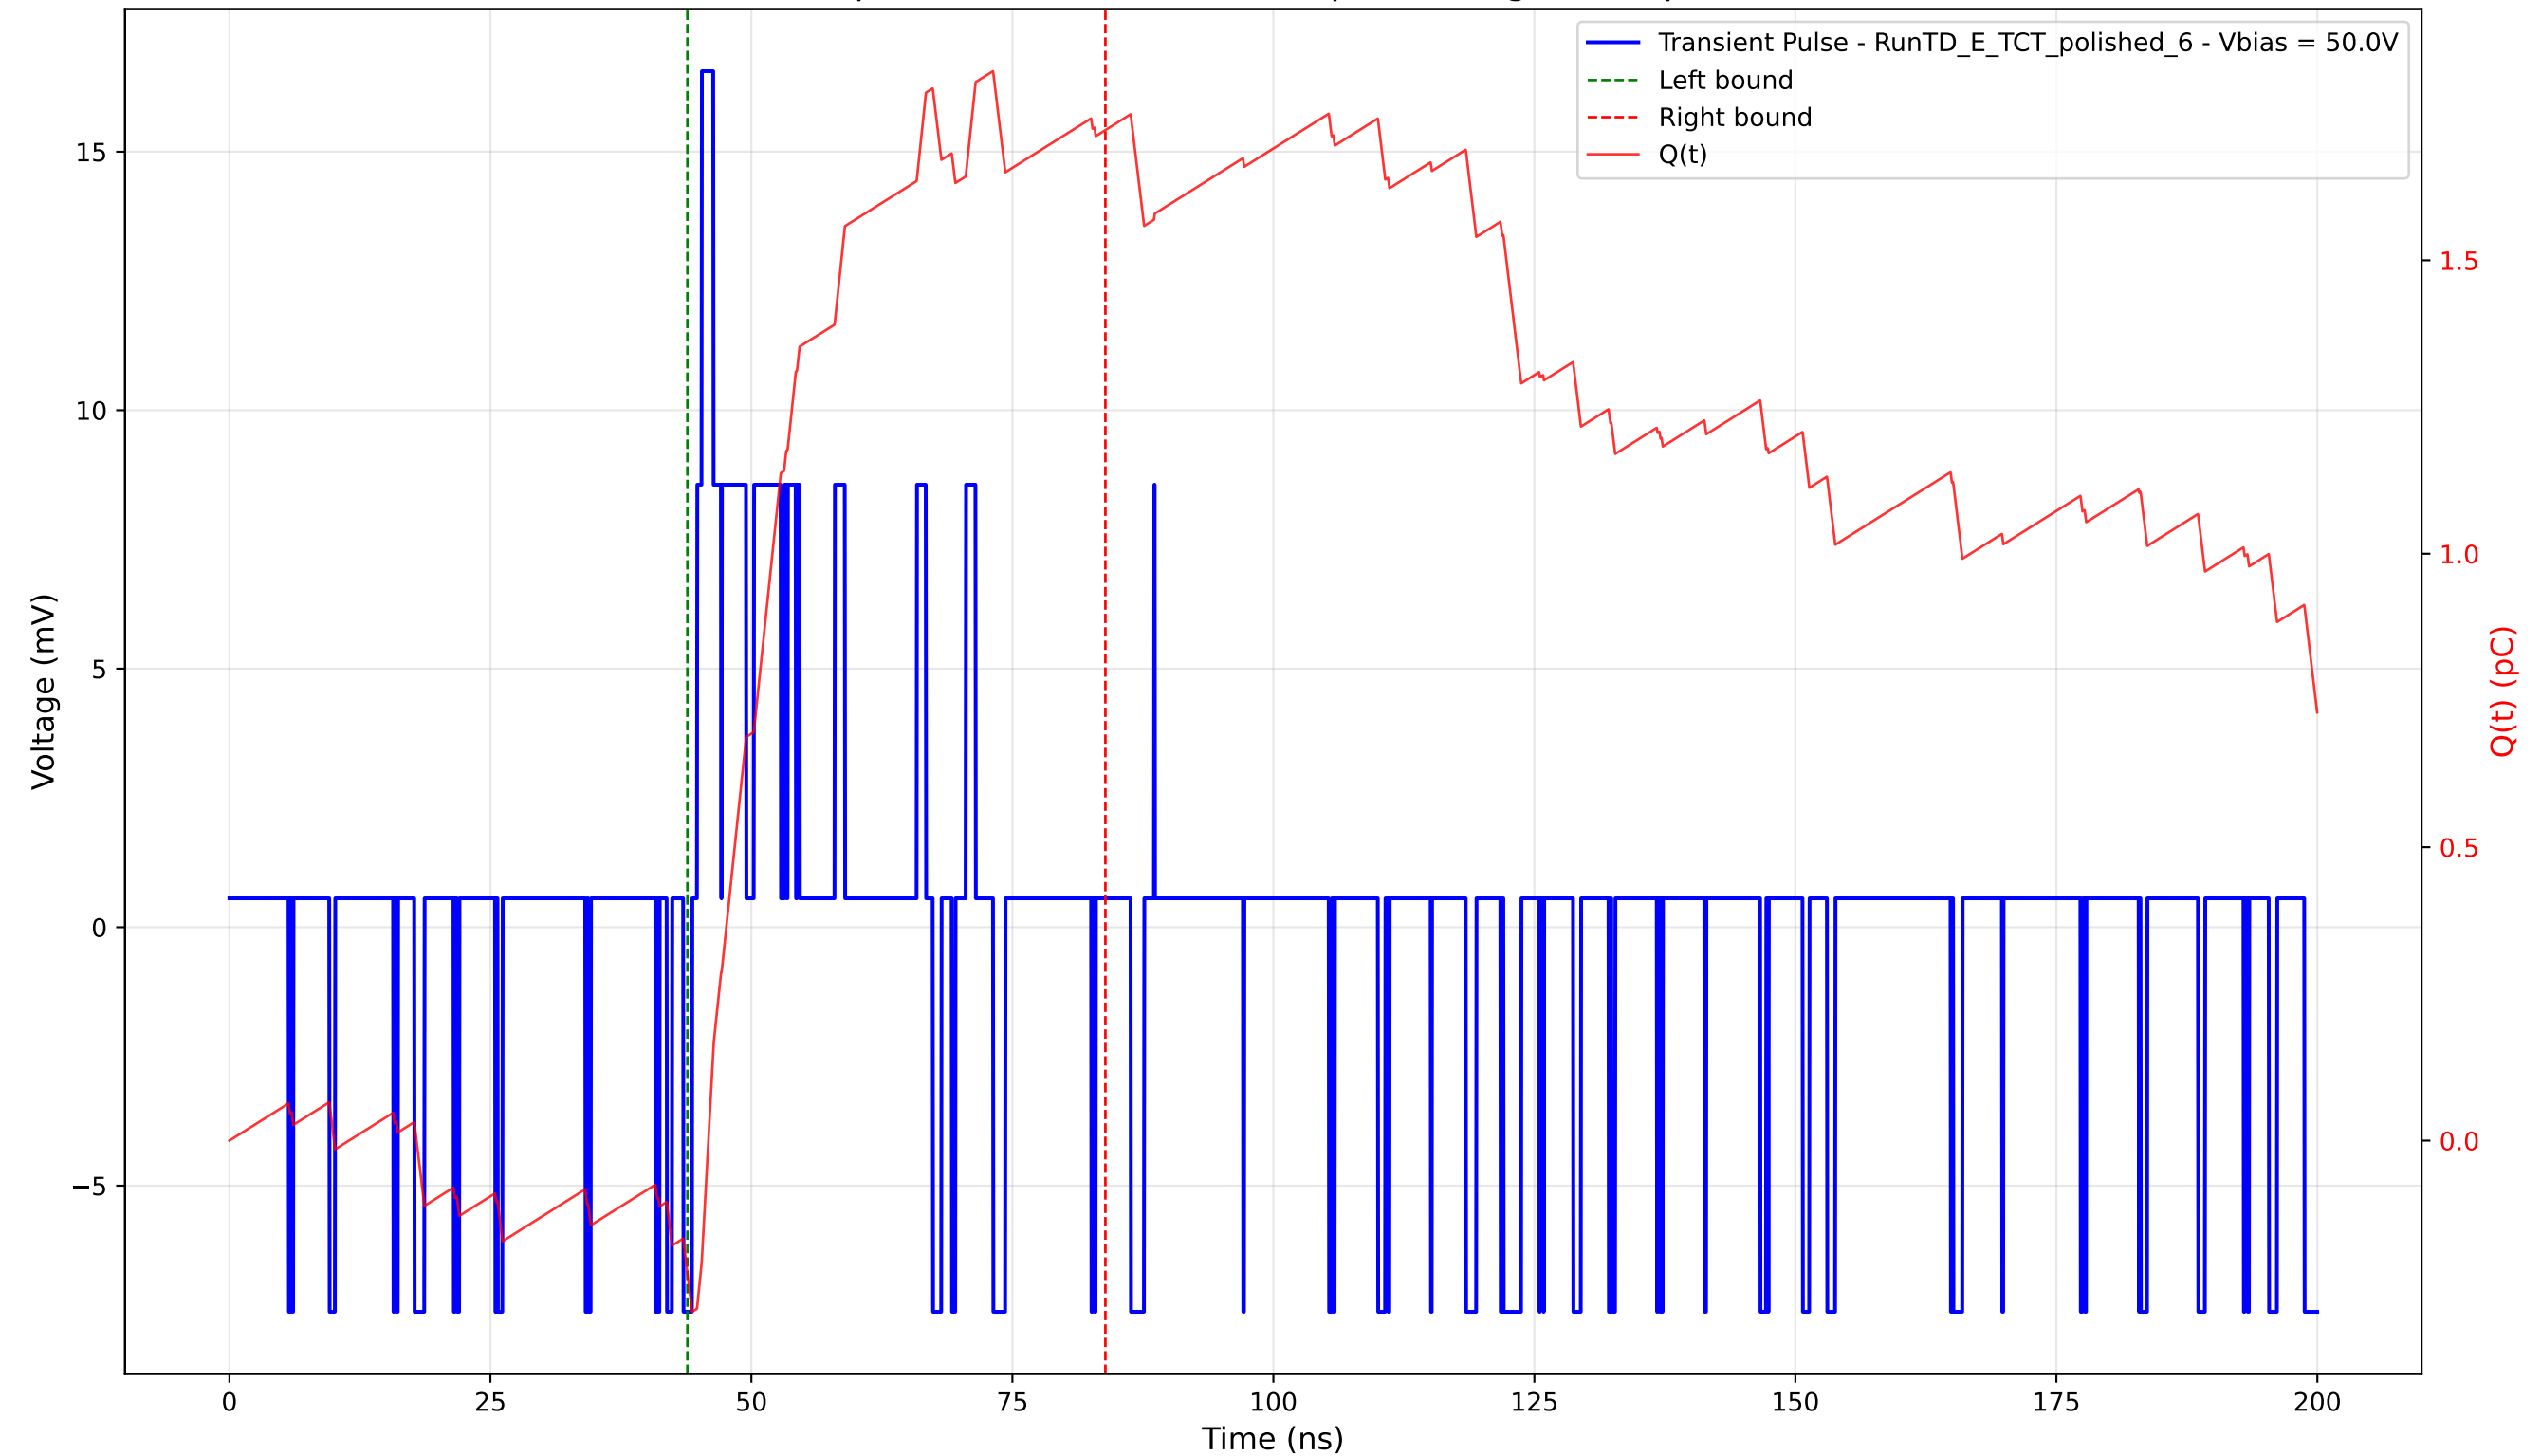


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 1.79 pC - Rise Time: 0.46 ns

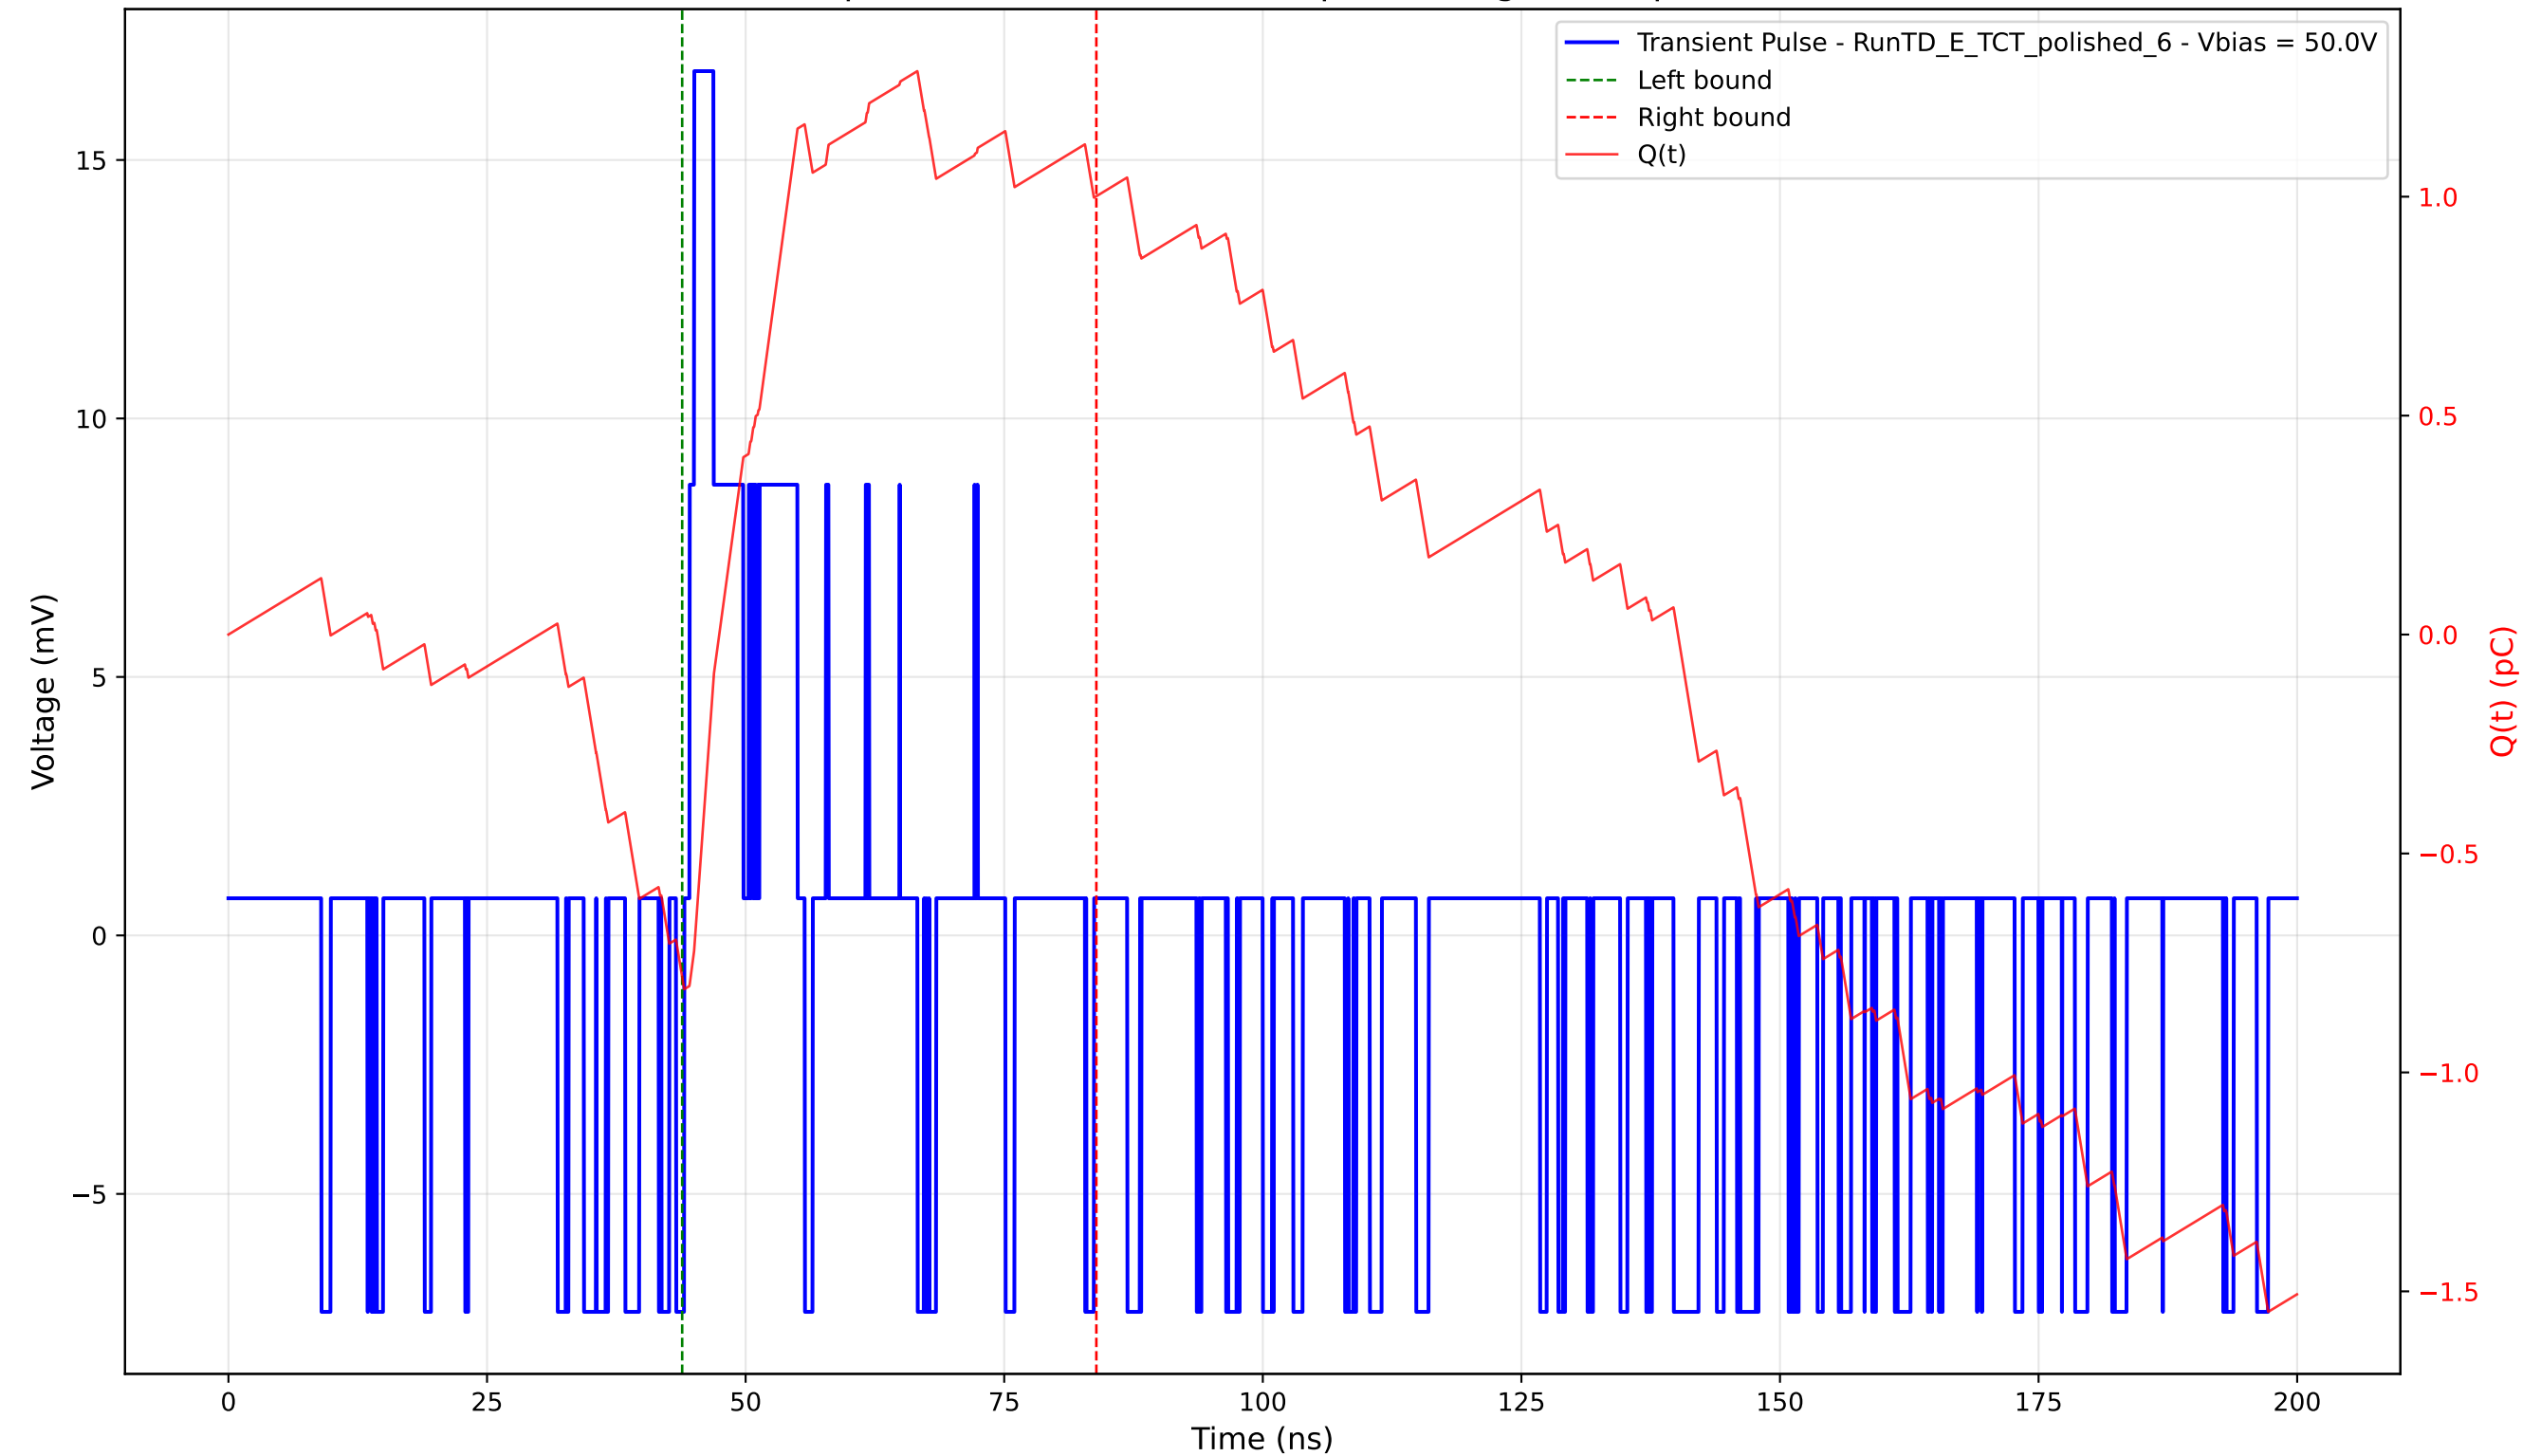


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 1.29 pC - Rise Time: 0.84 ns

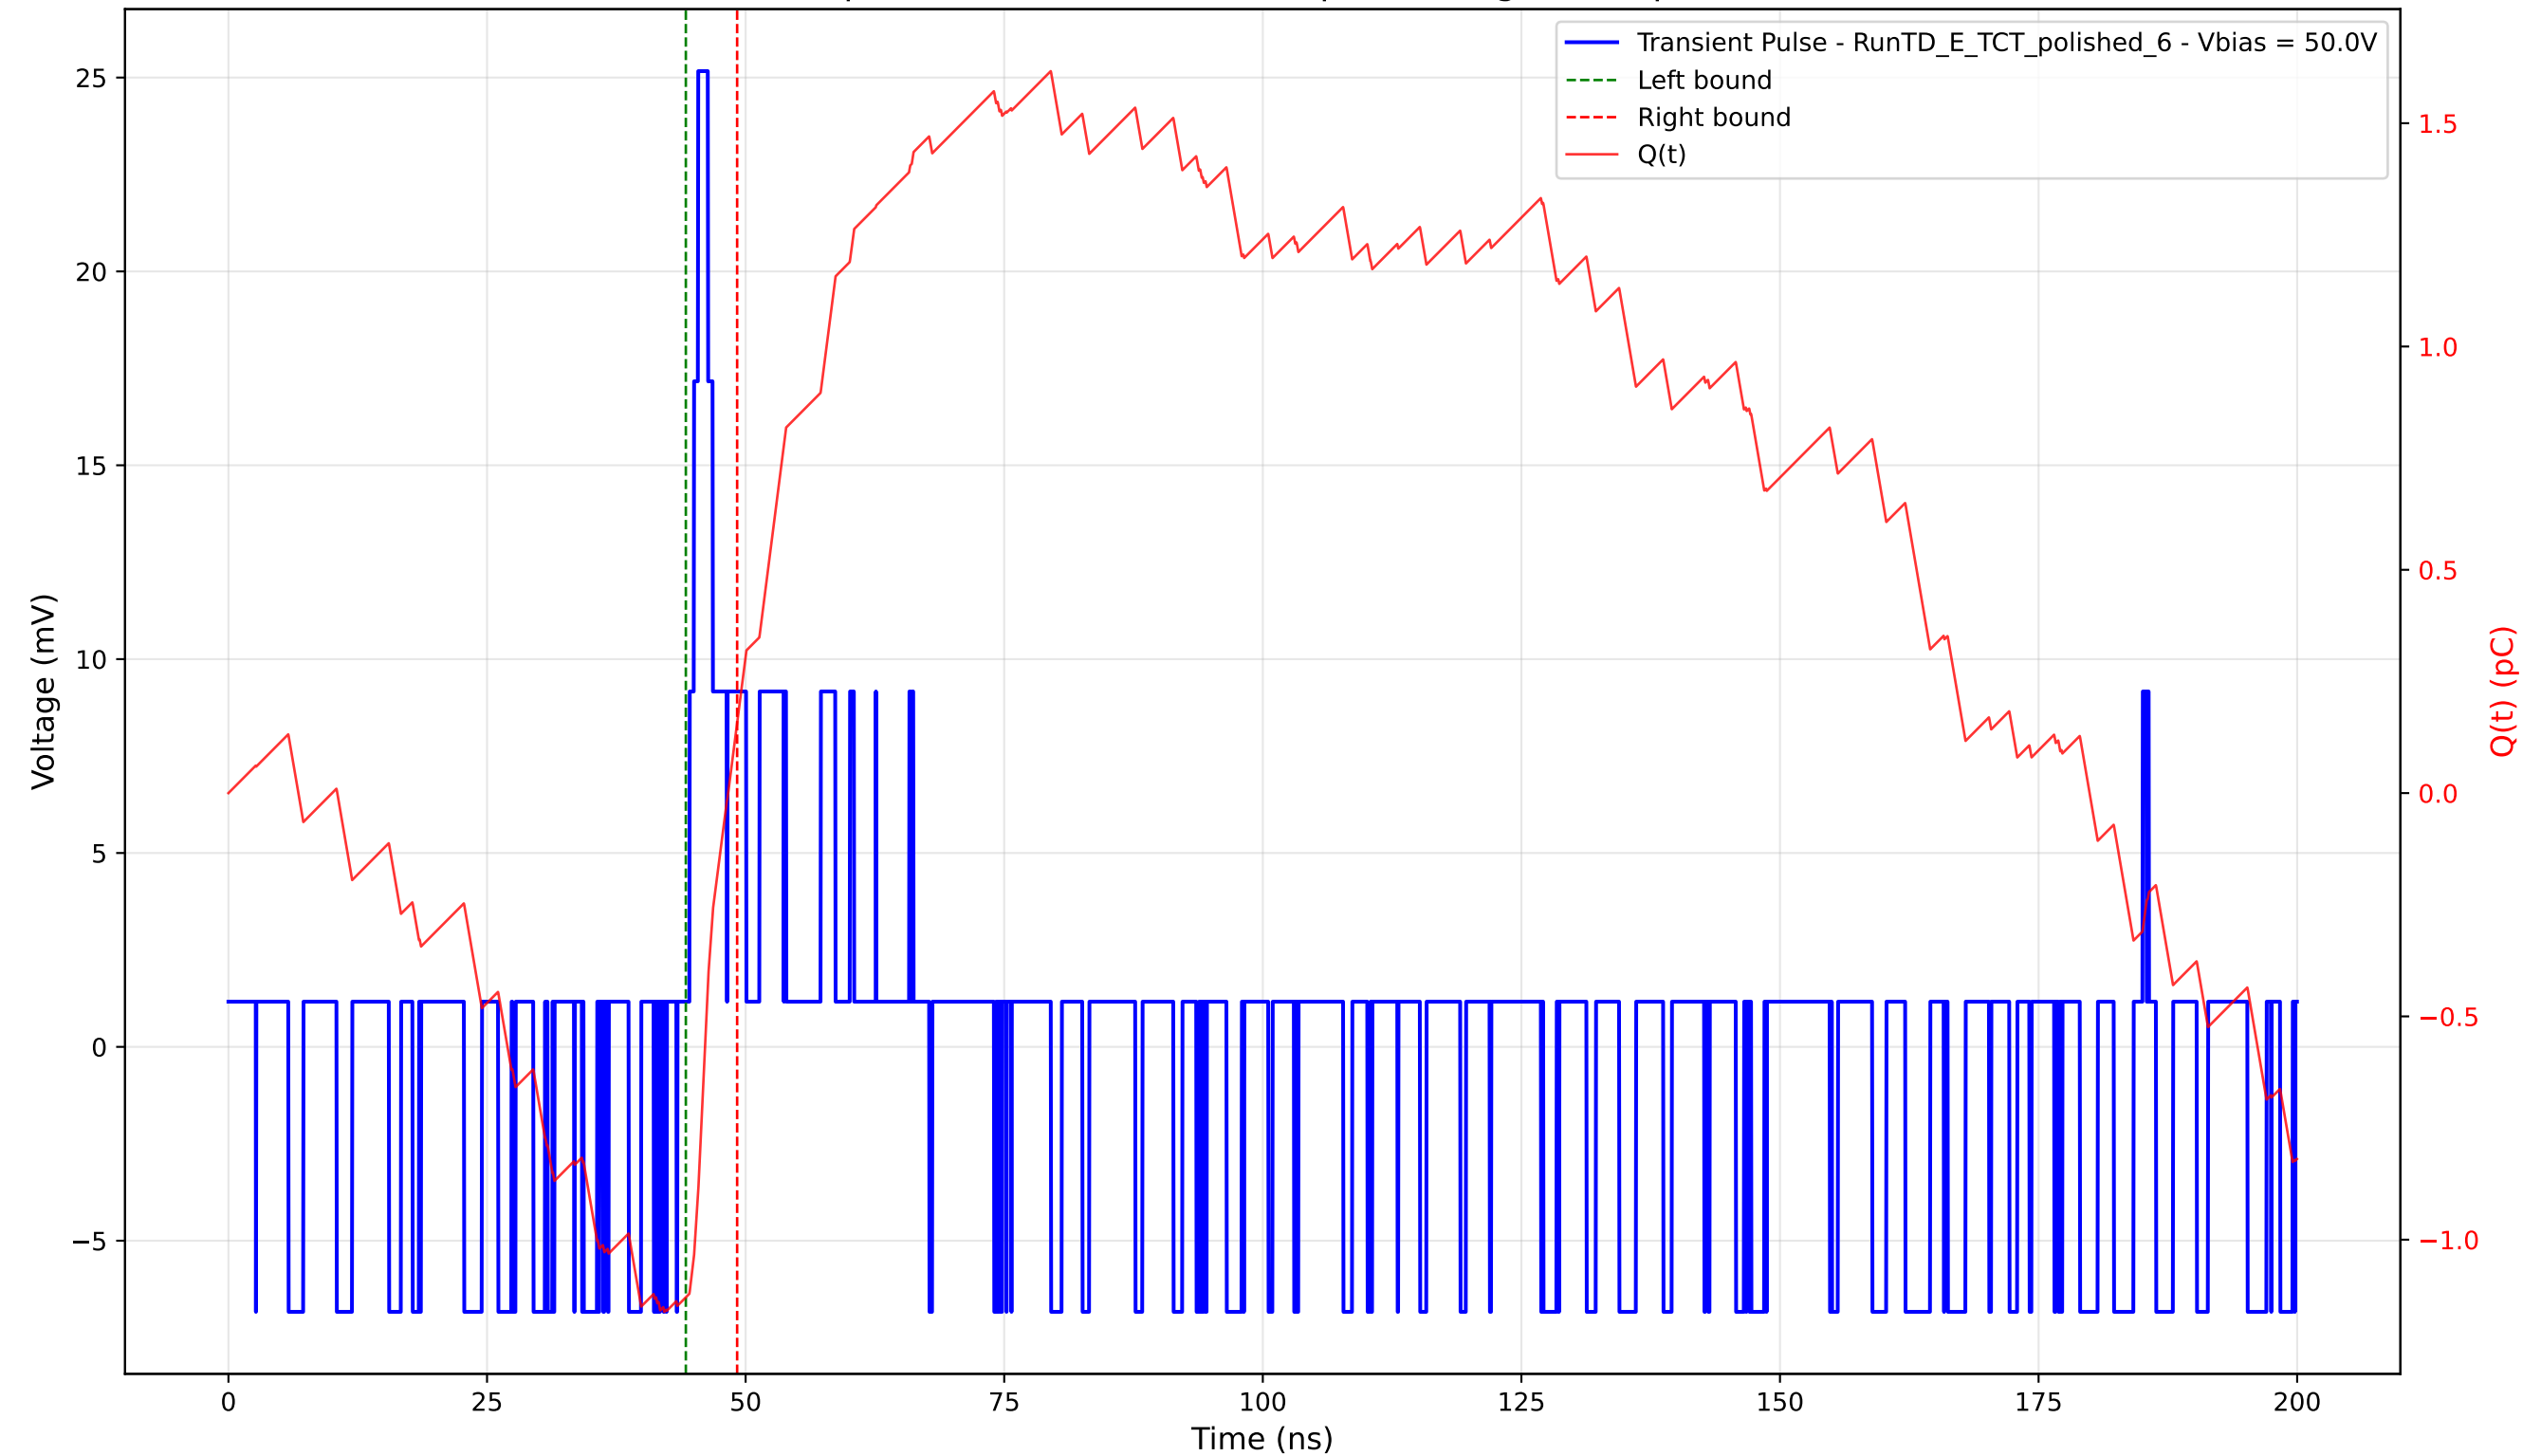


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 1.20 pC - Rise Time: 0.72 ns

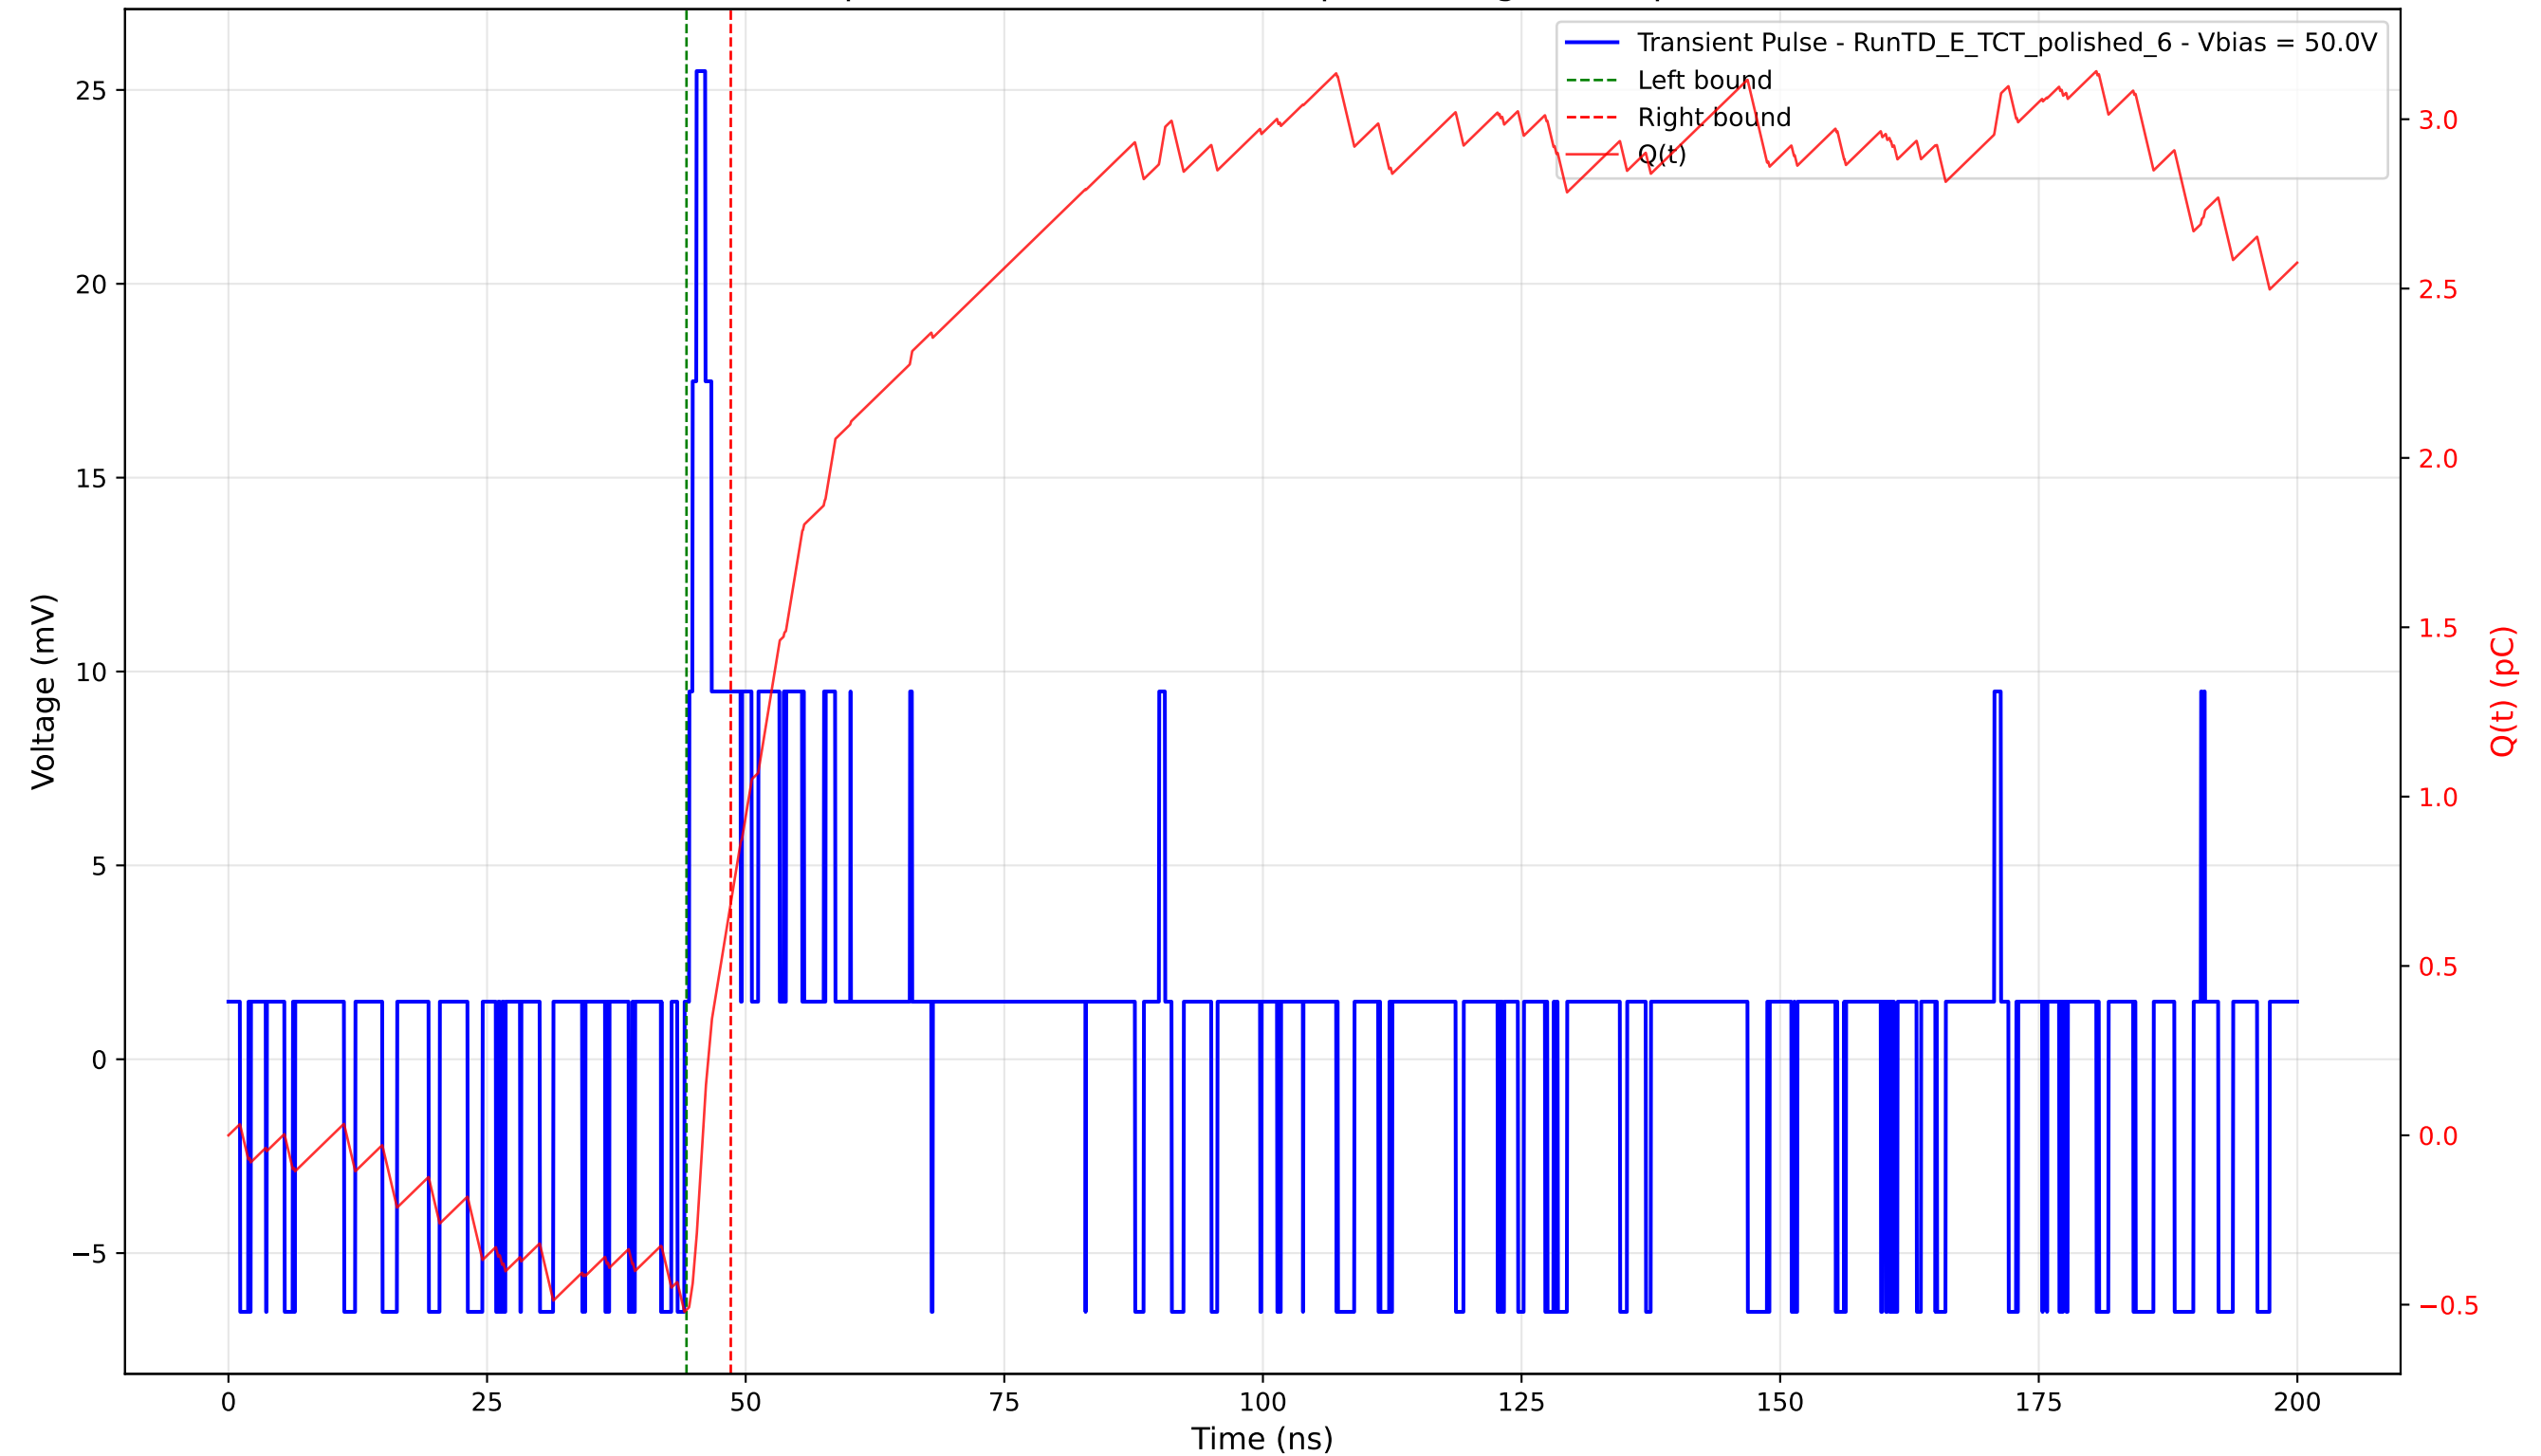


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 1.16 pC - Rise Time: 0.74 ns

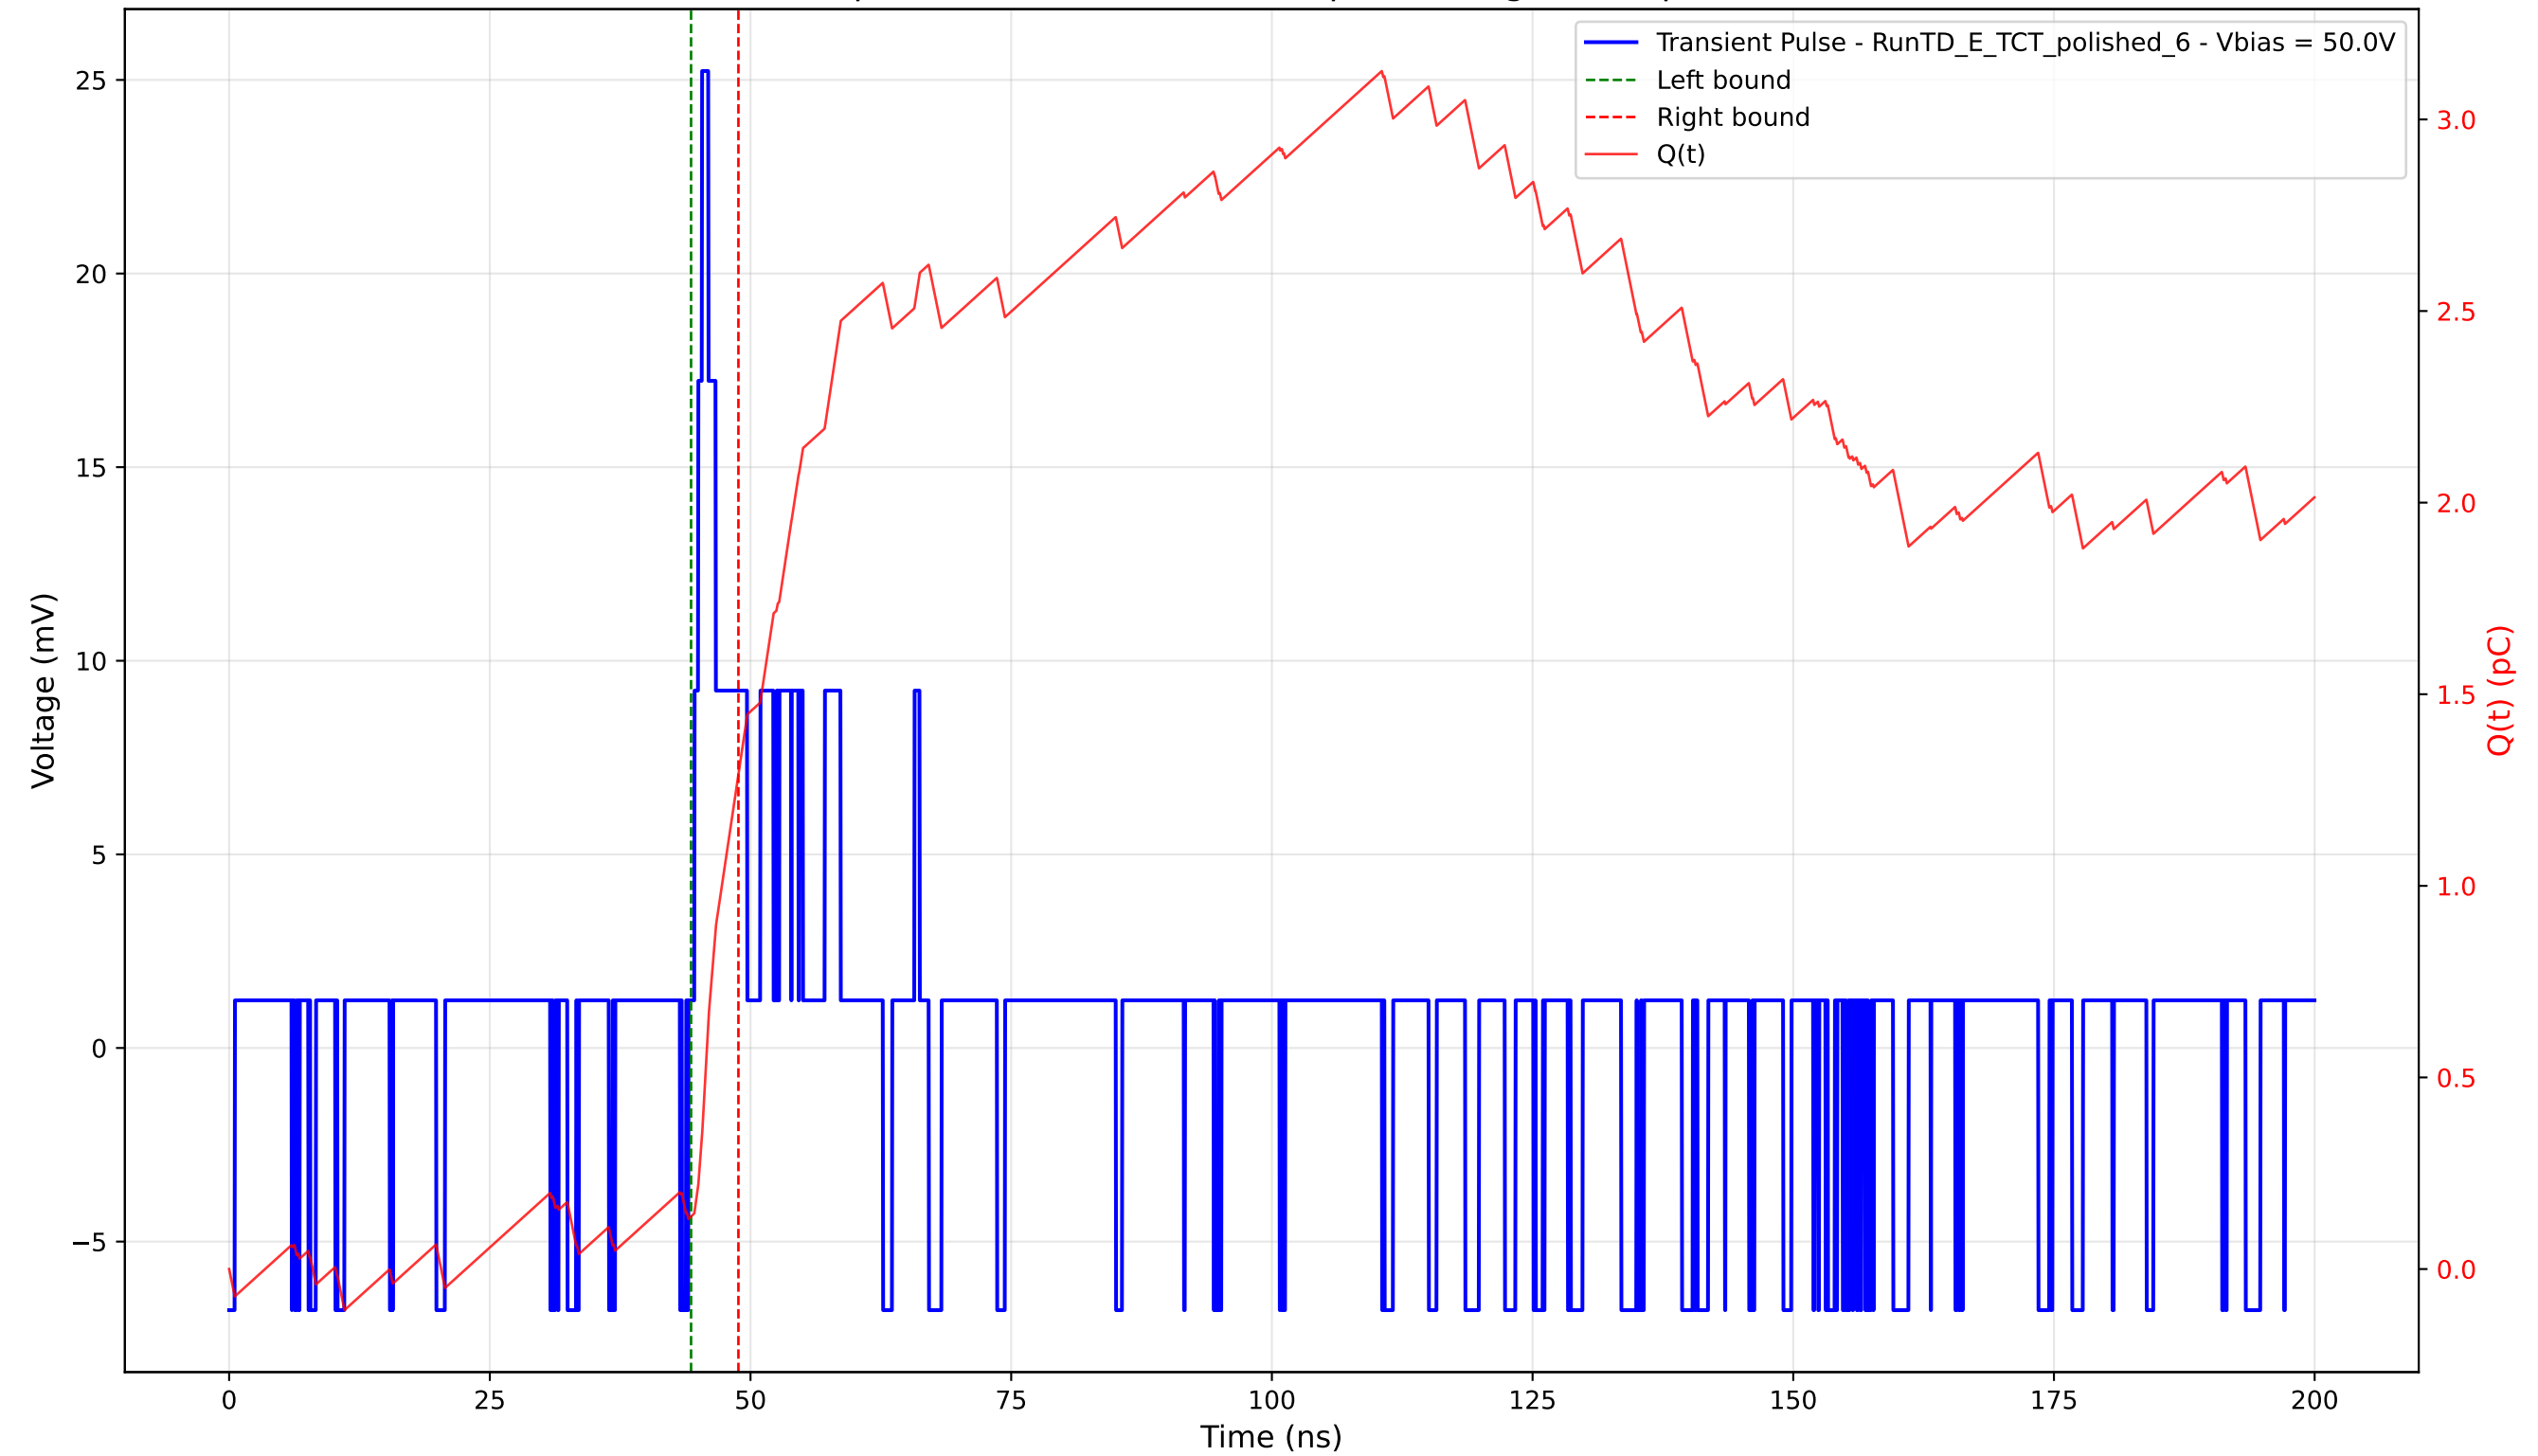


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 1.67 pC - Rise Time: 0.59 ns

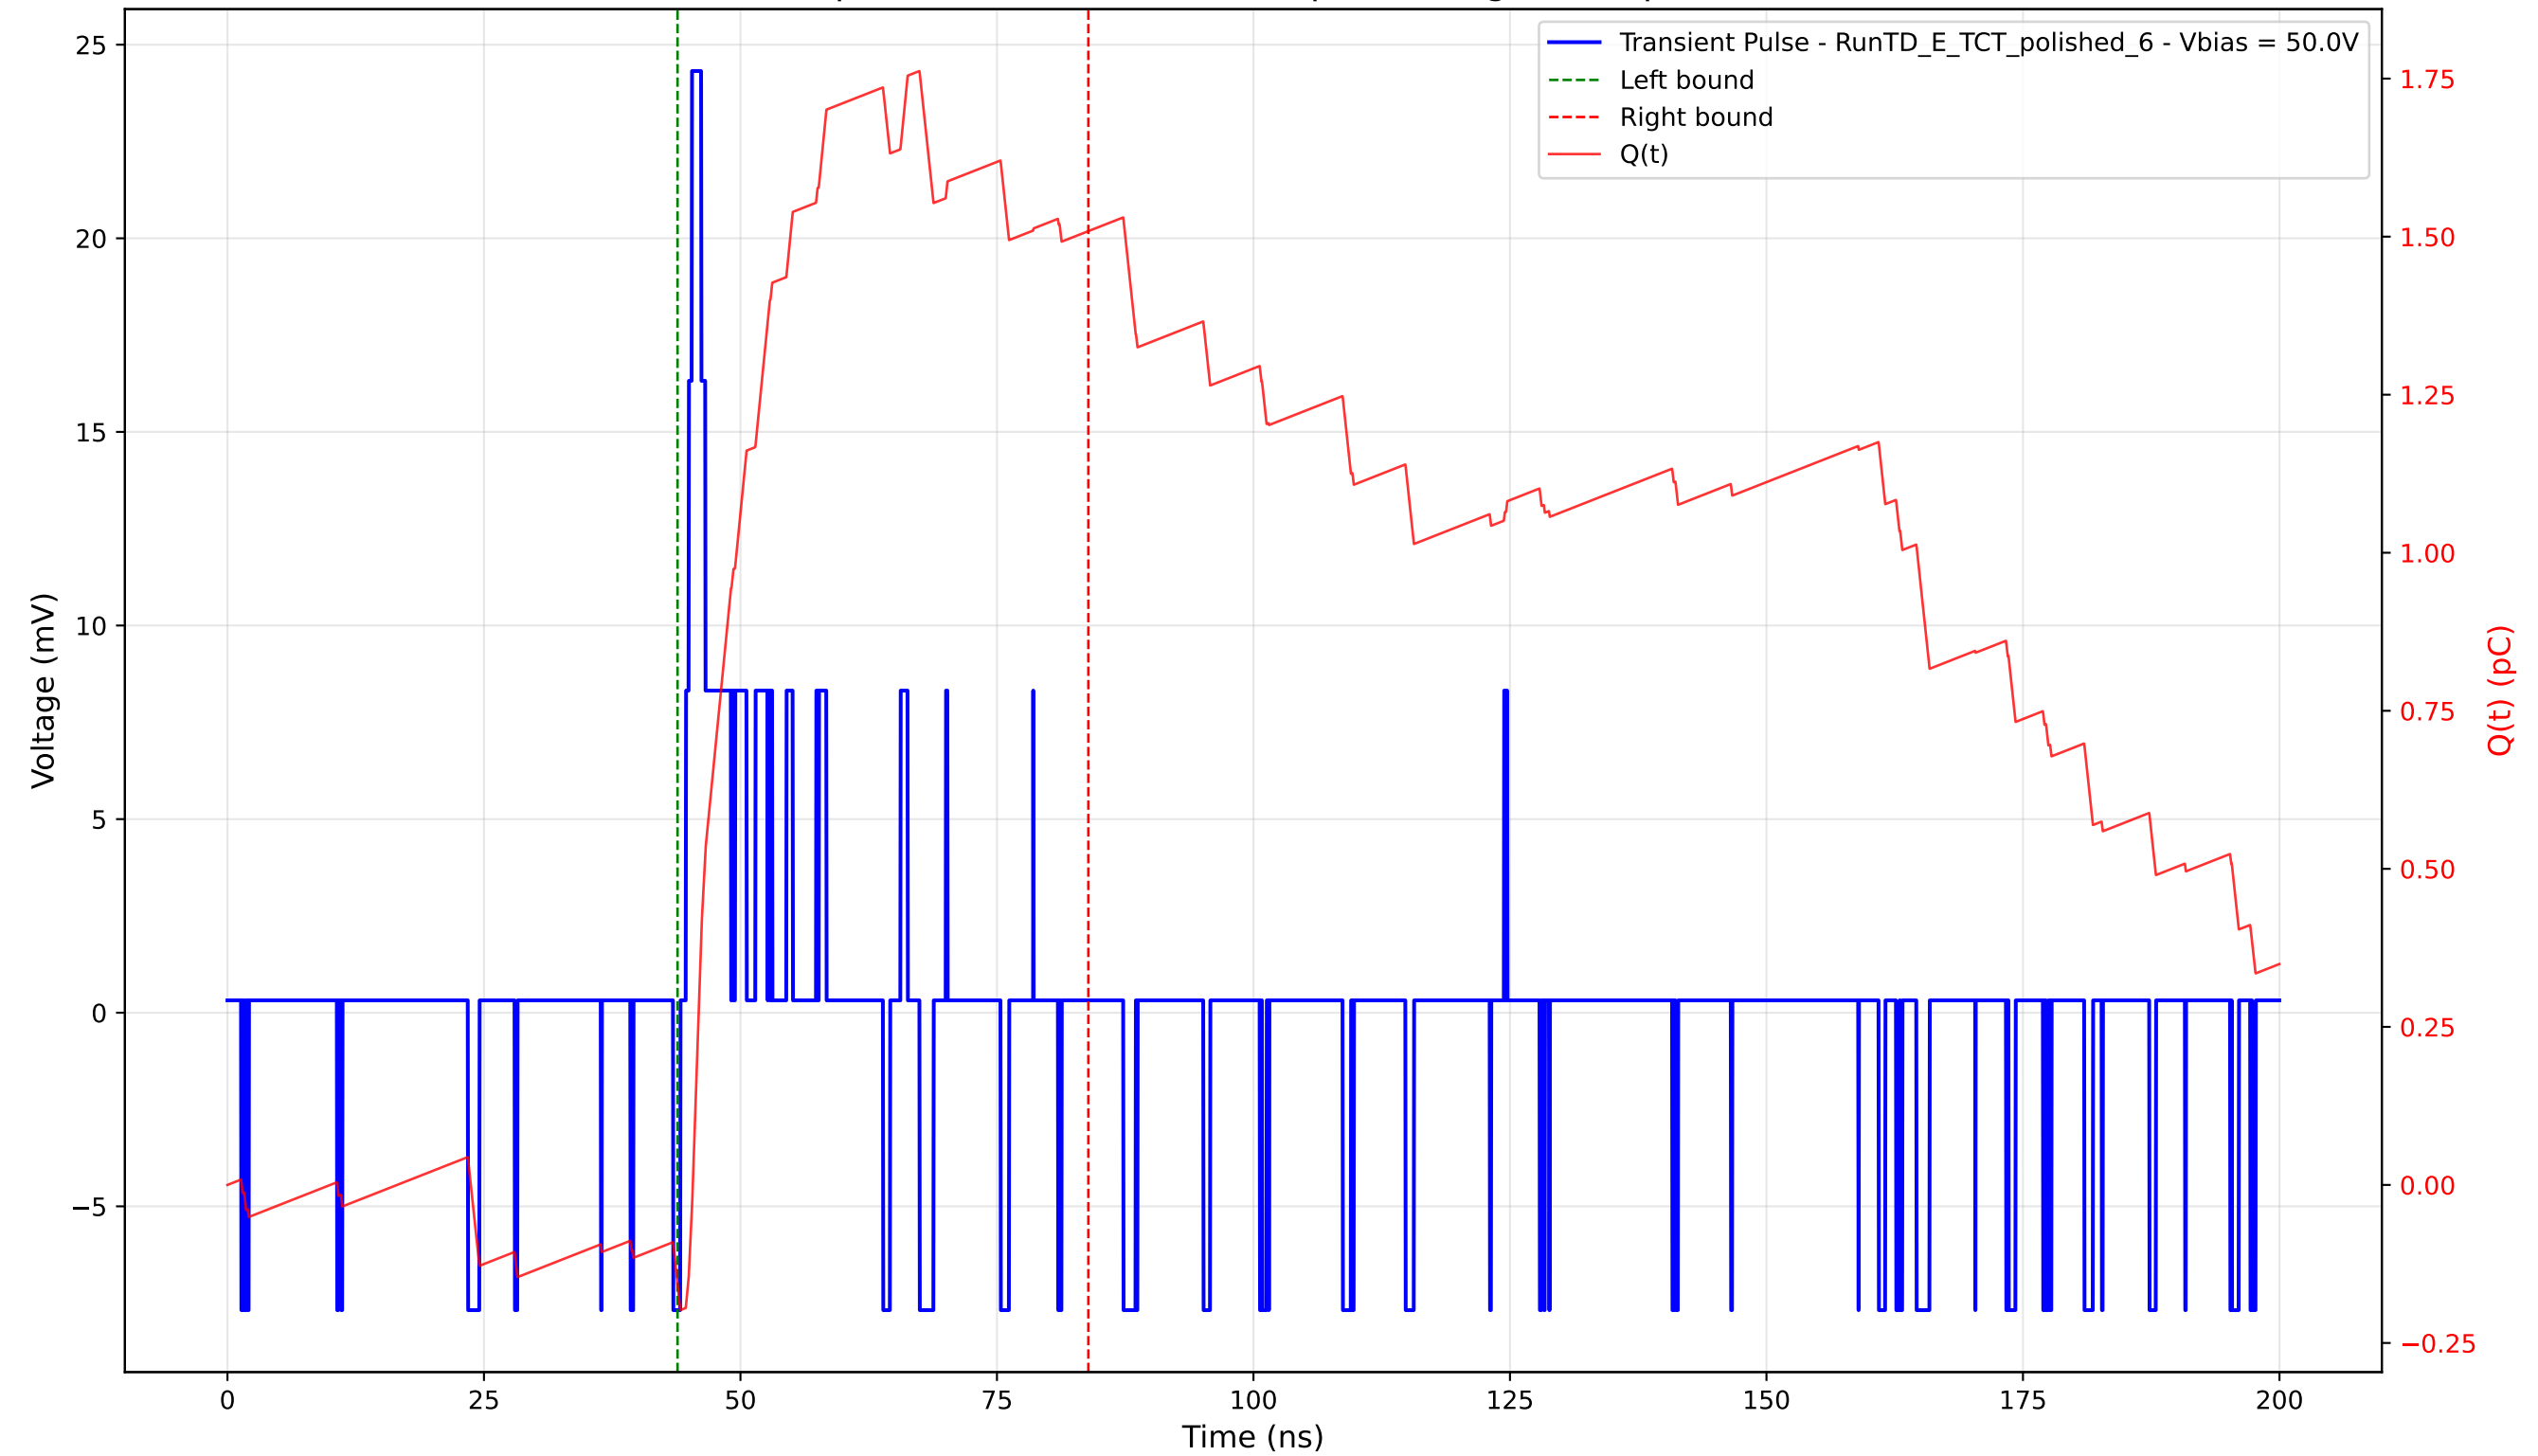


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 1.00 pC - Rise Time: 0.34 ns

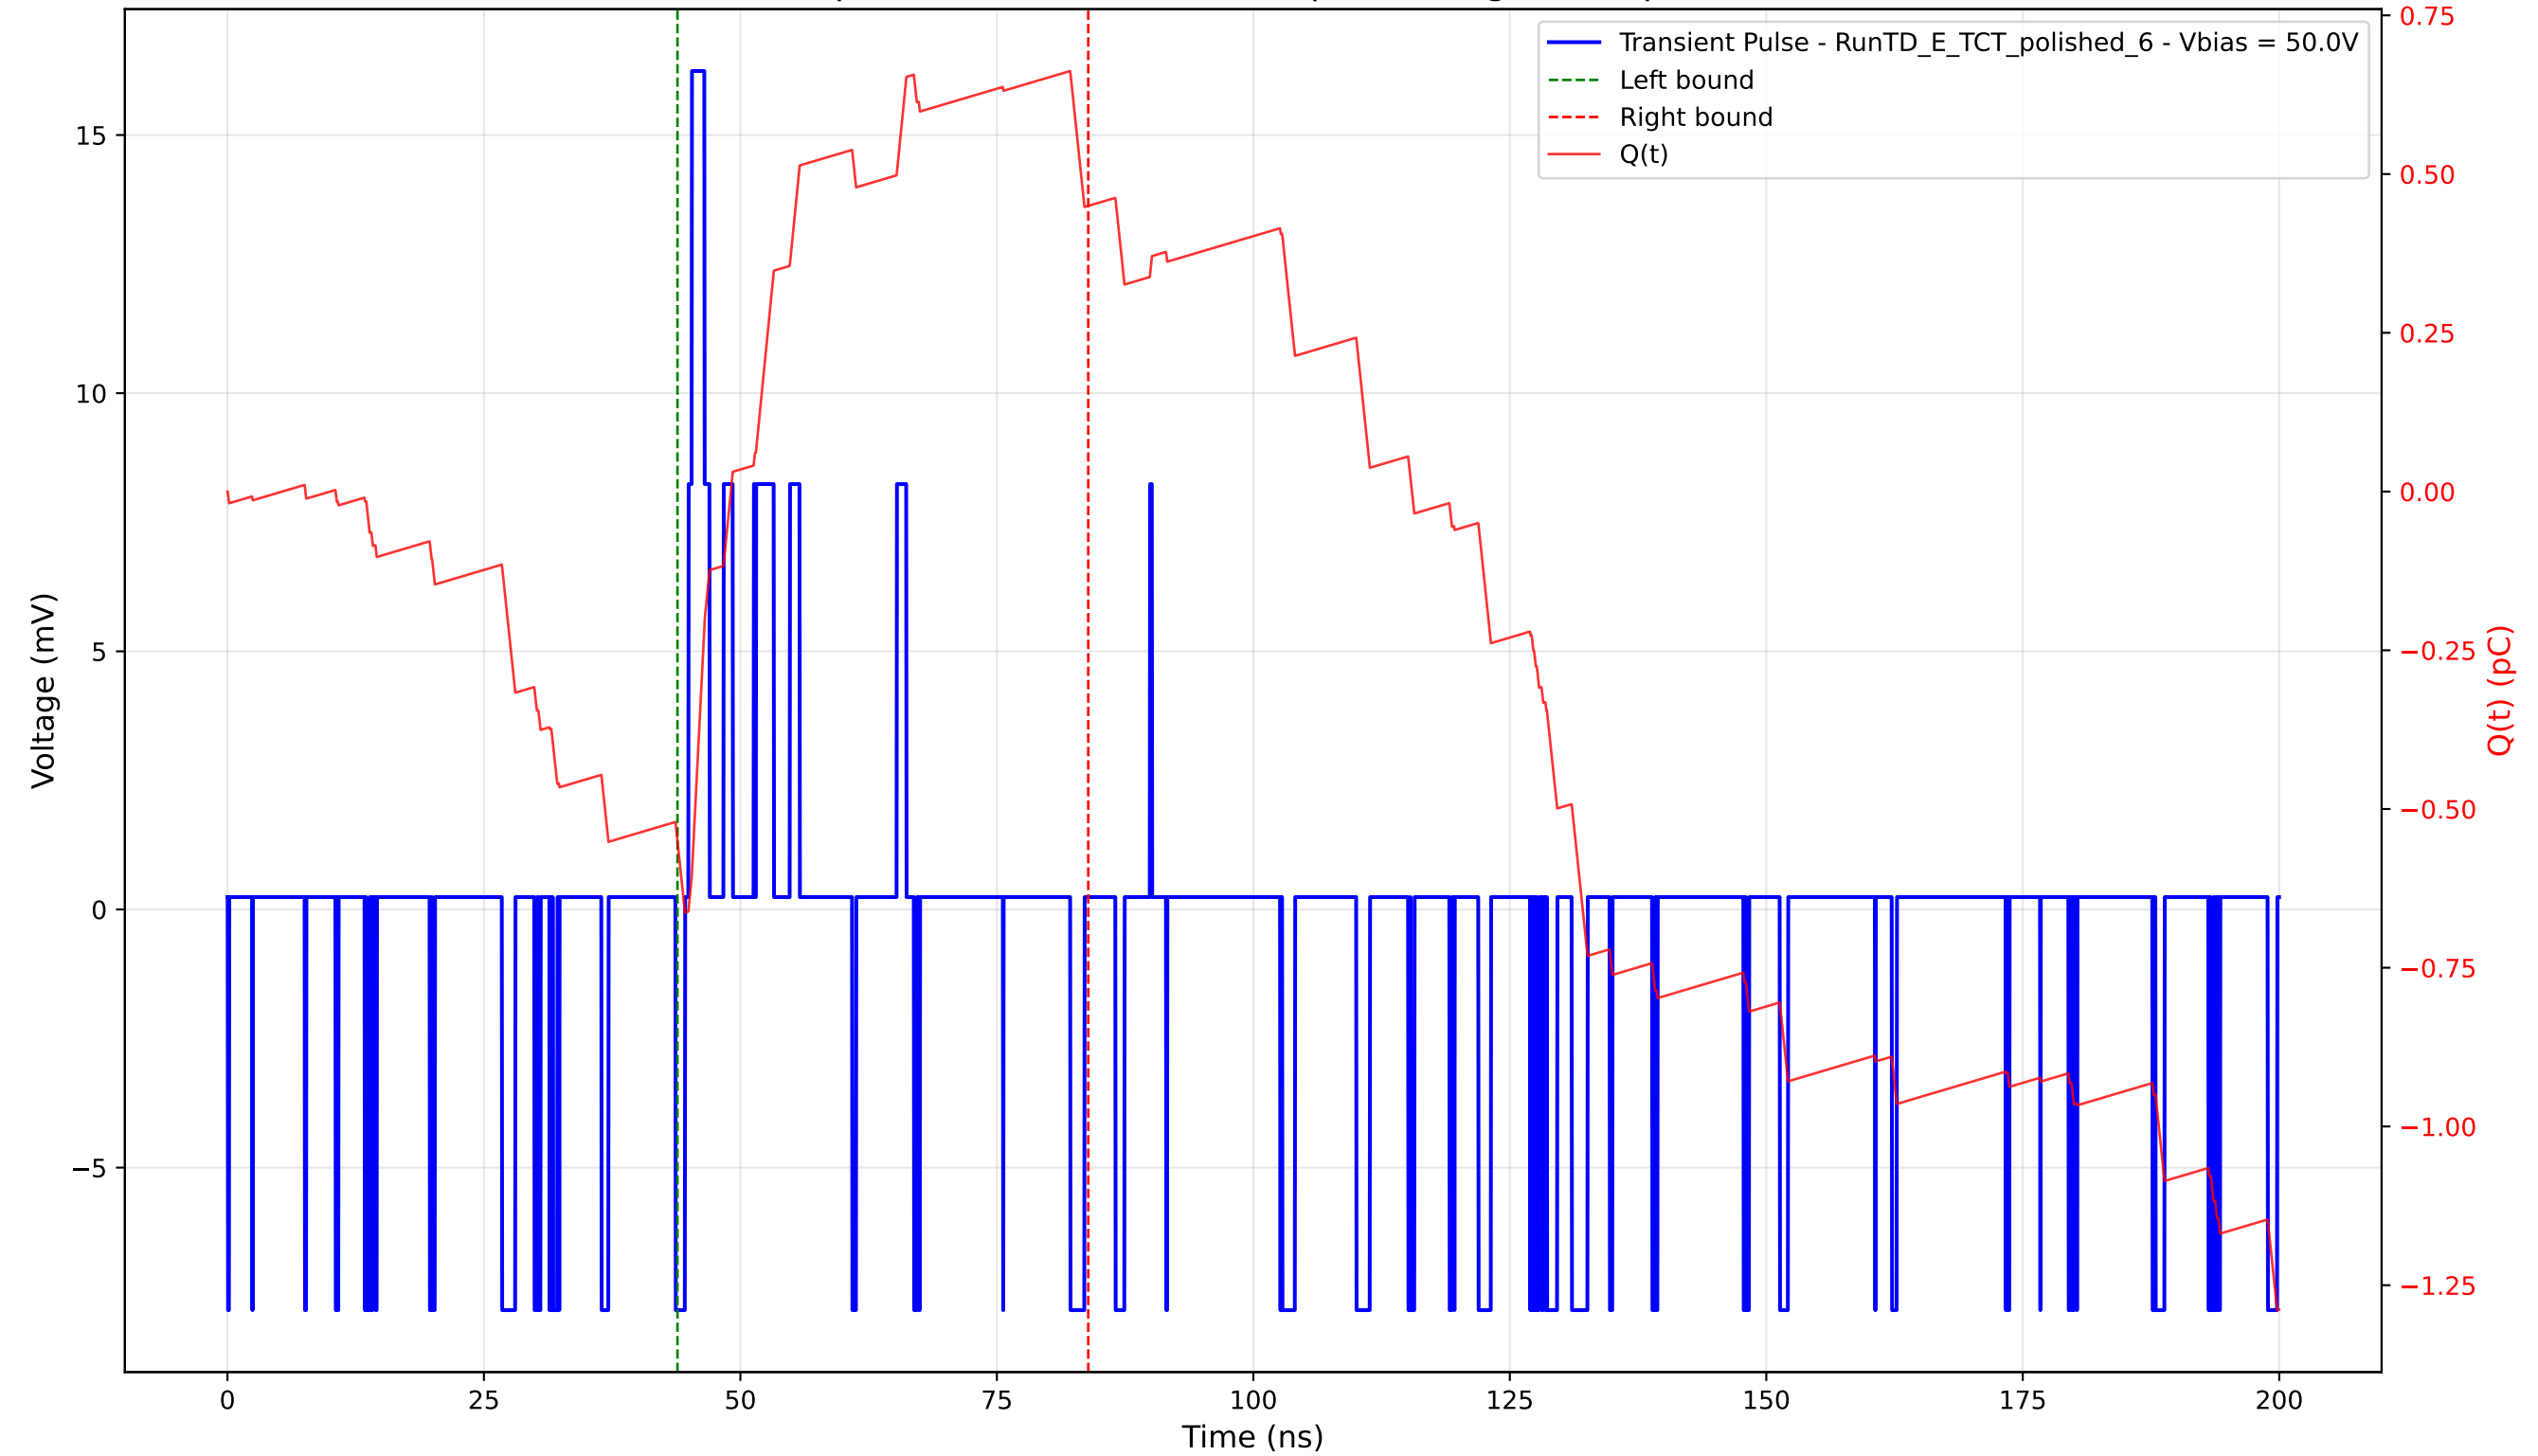


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 0.91 pC - Rise Time: 0.00 ns (N/A)

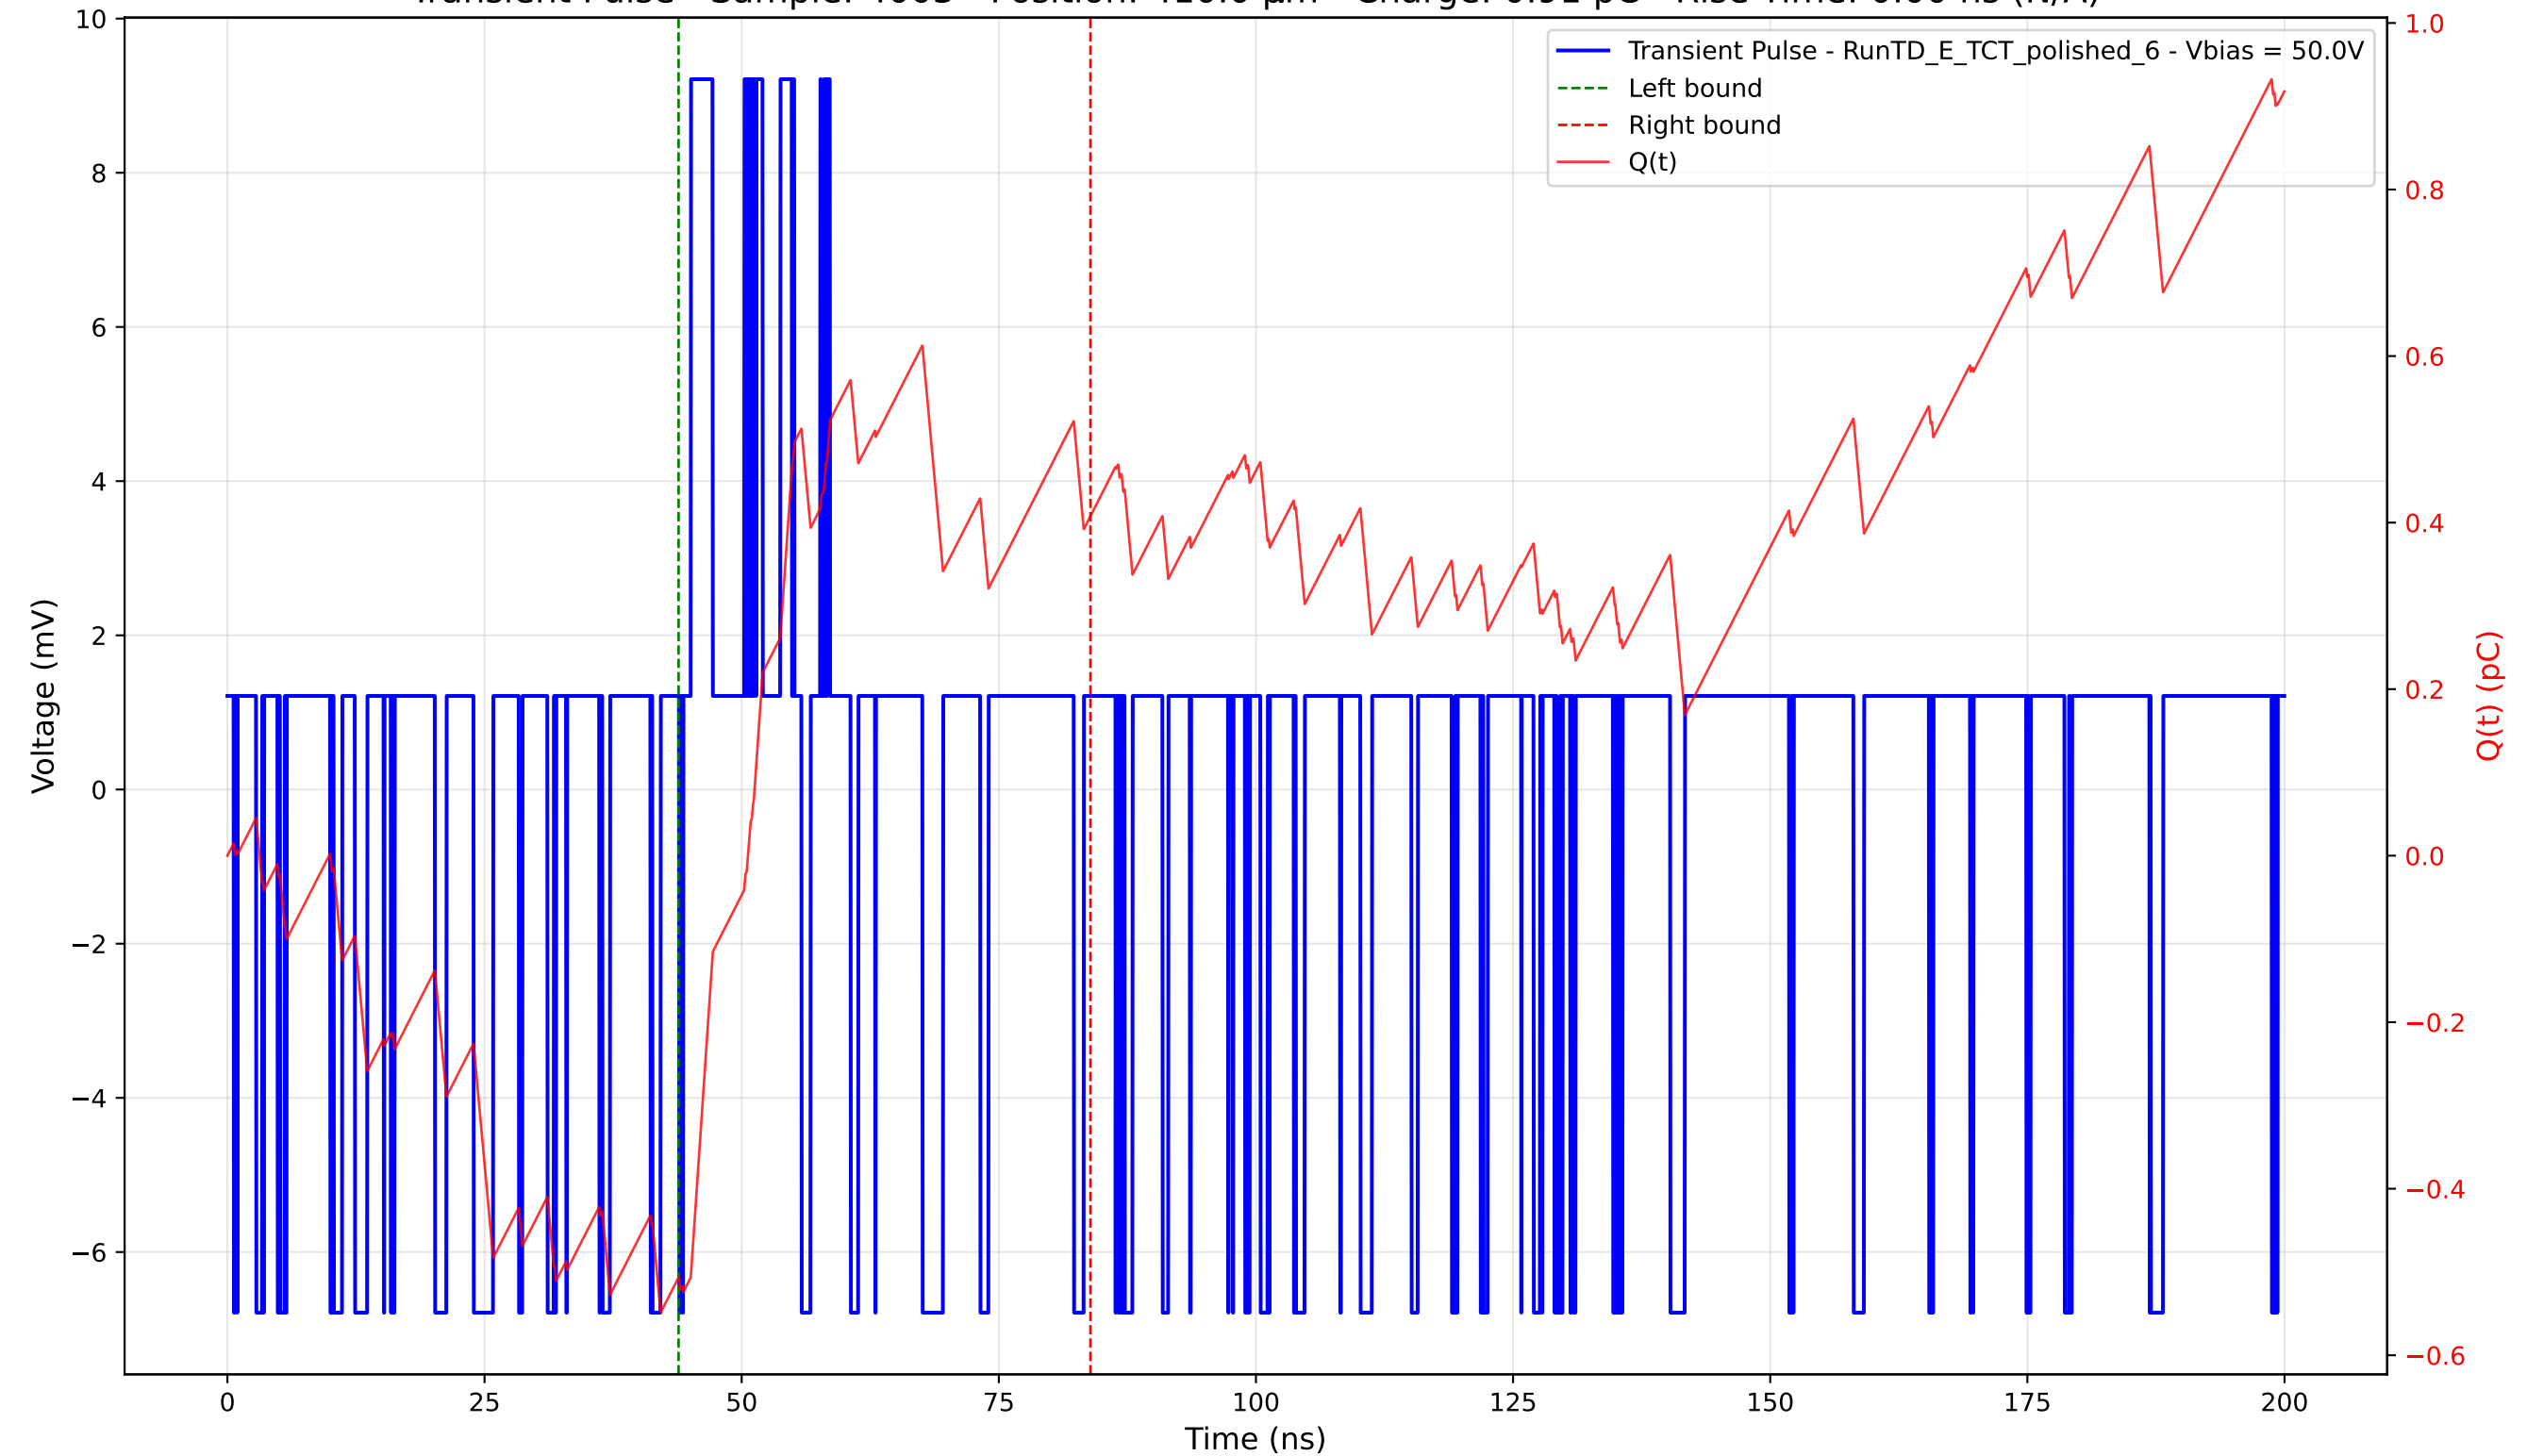

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 0.33 pC - Rise Time: 0.00 ns (N/A)

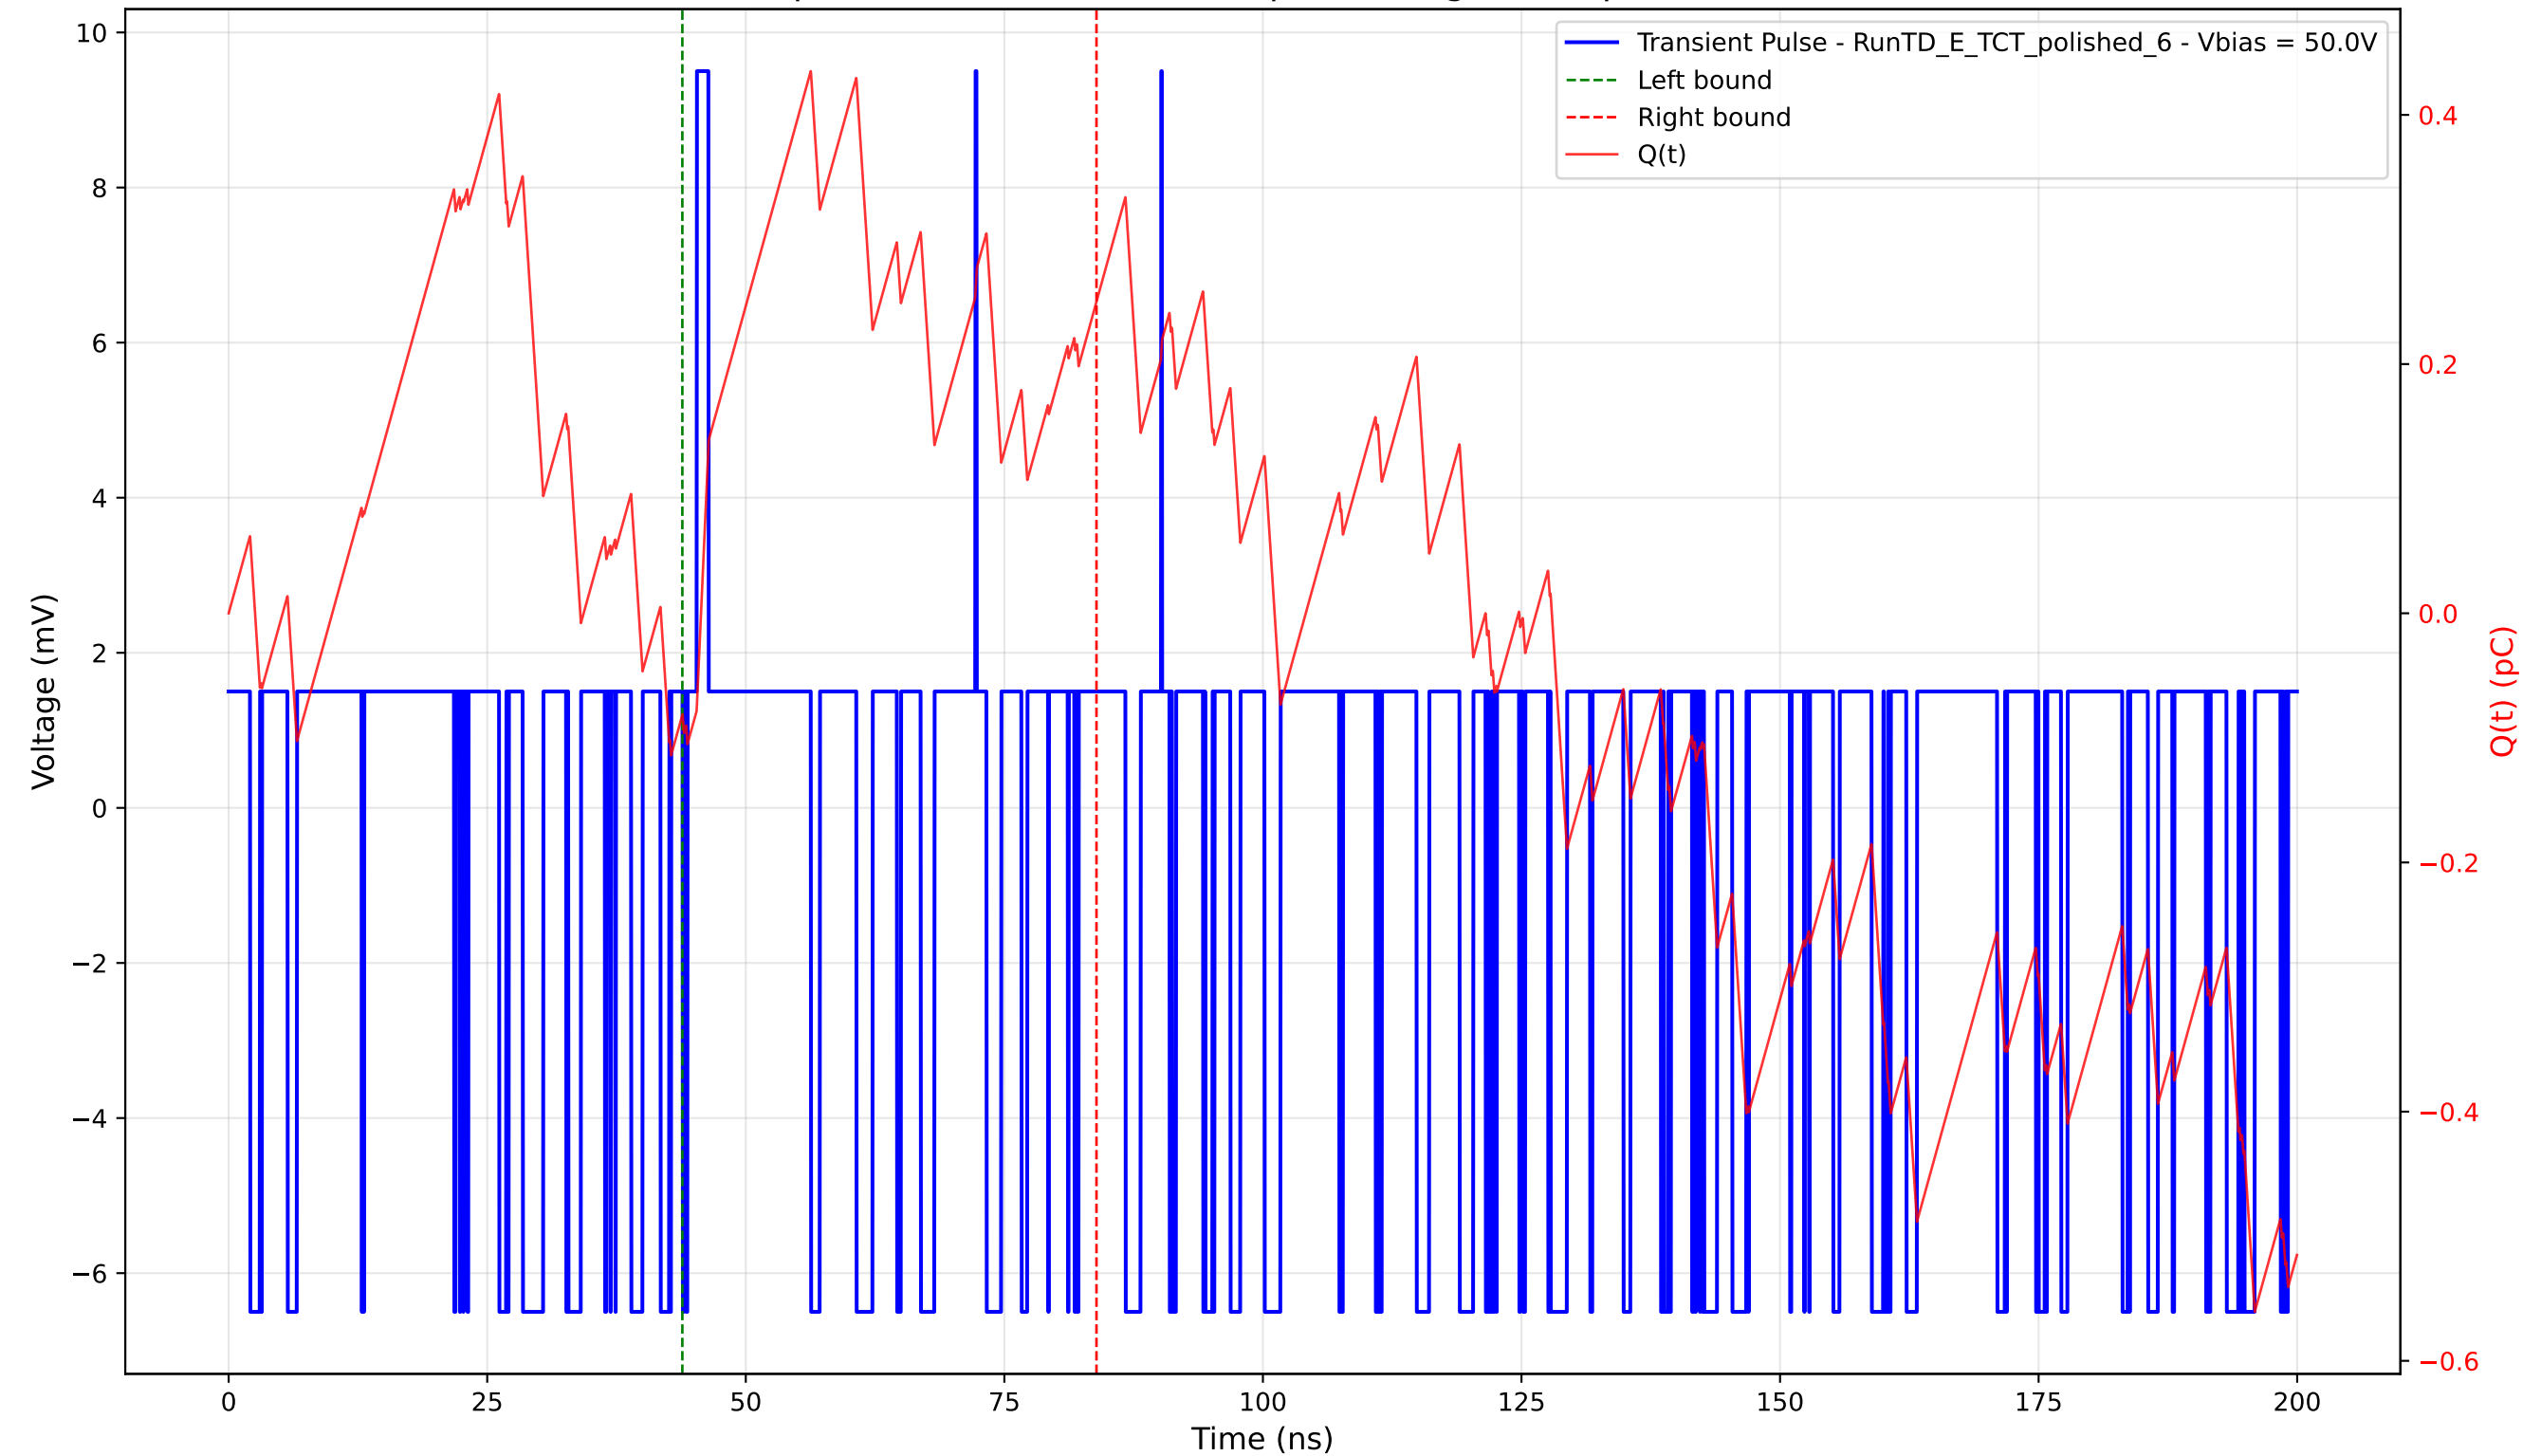

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 0.13 pC - Rise Time: 0.02 ns

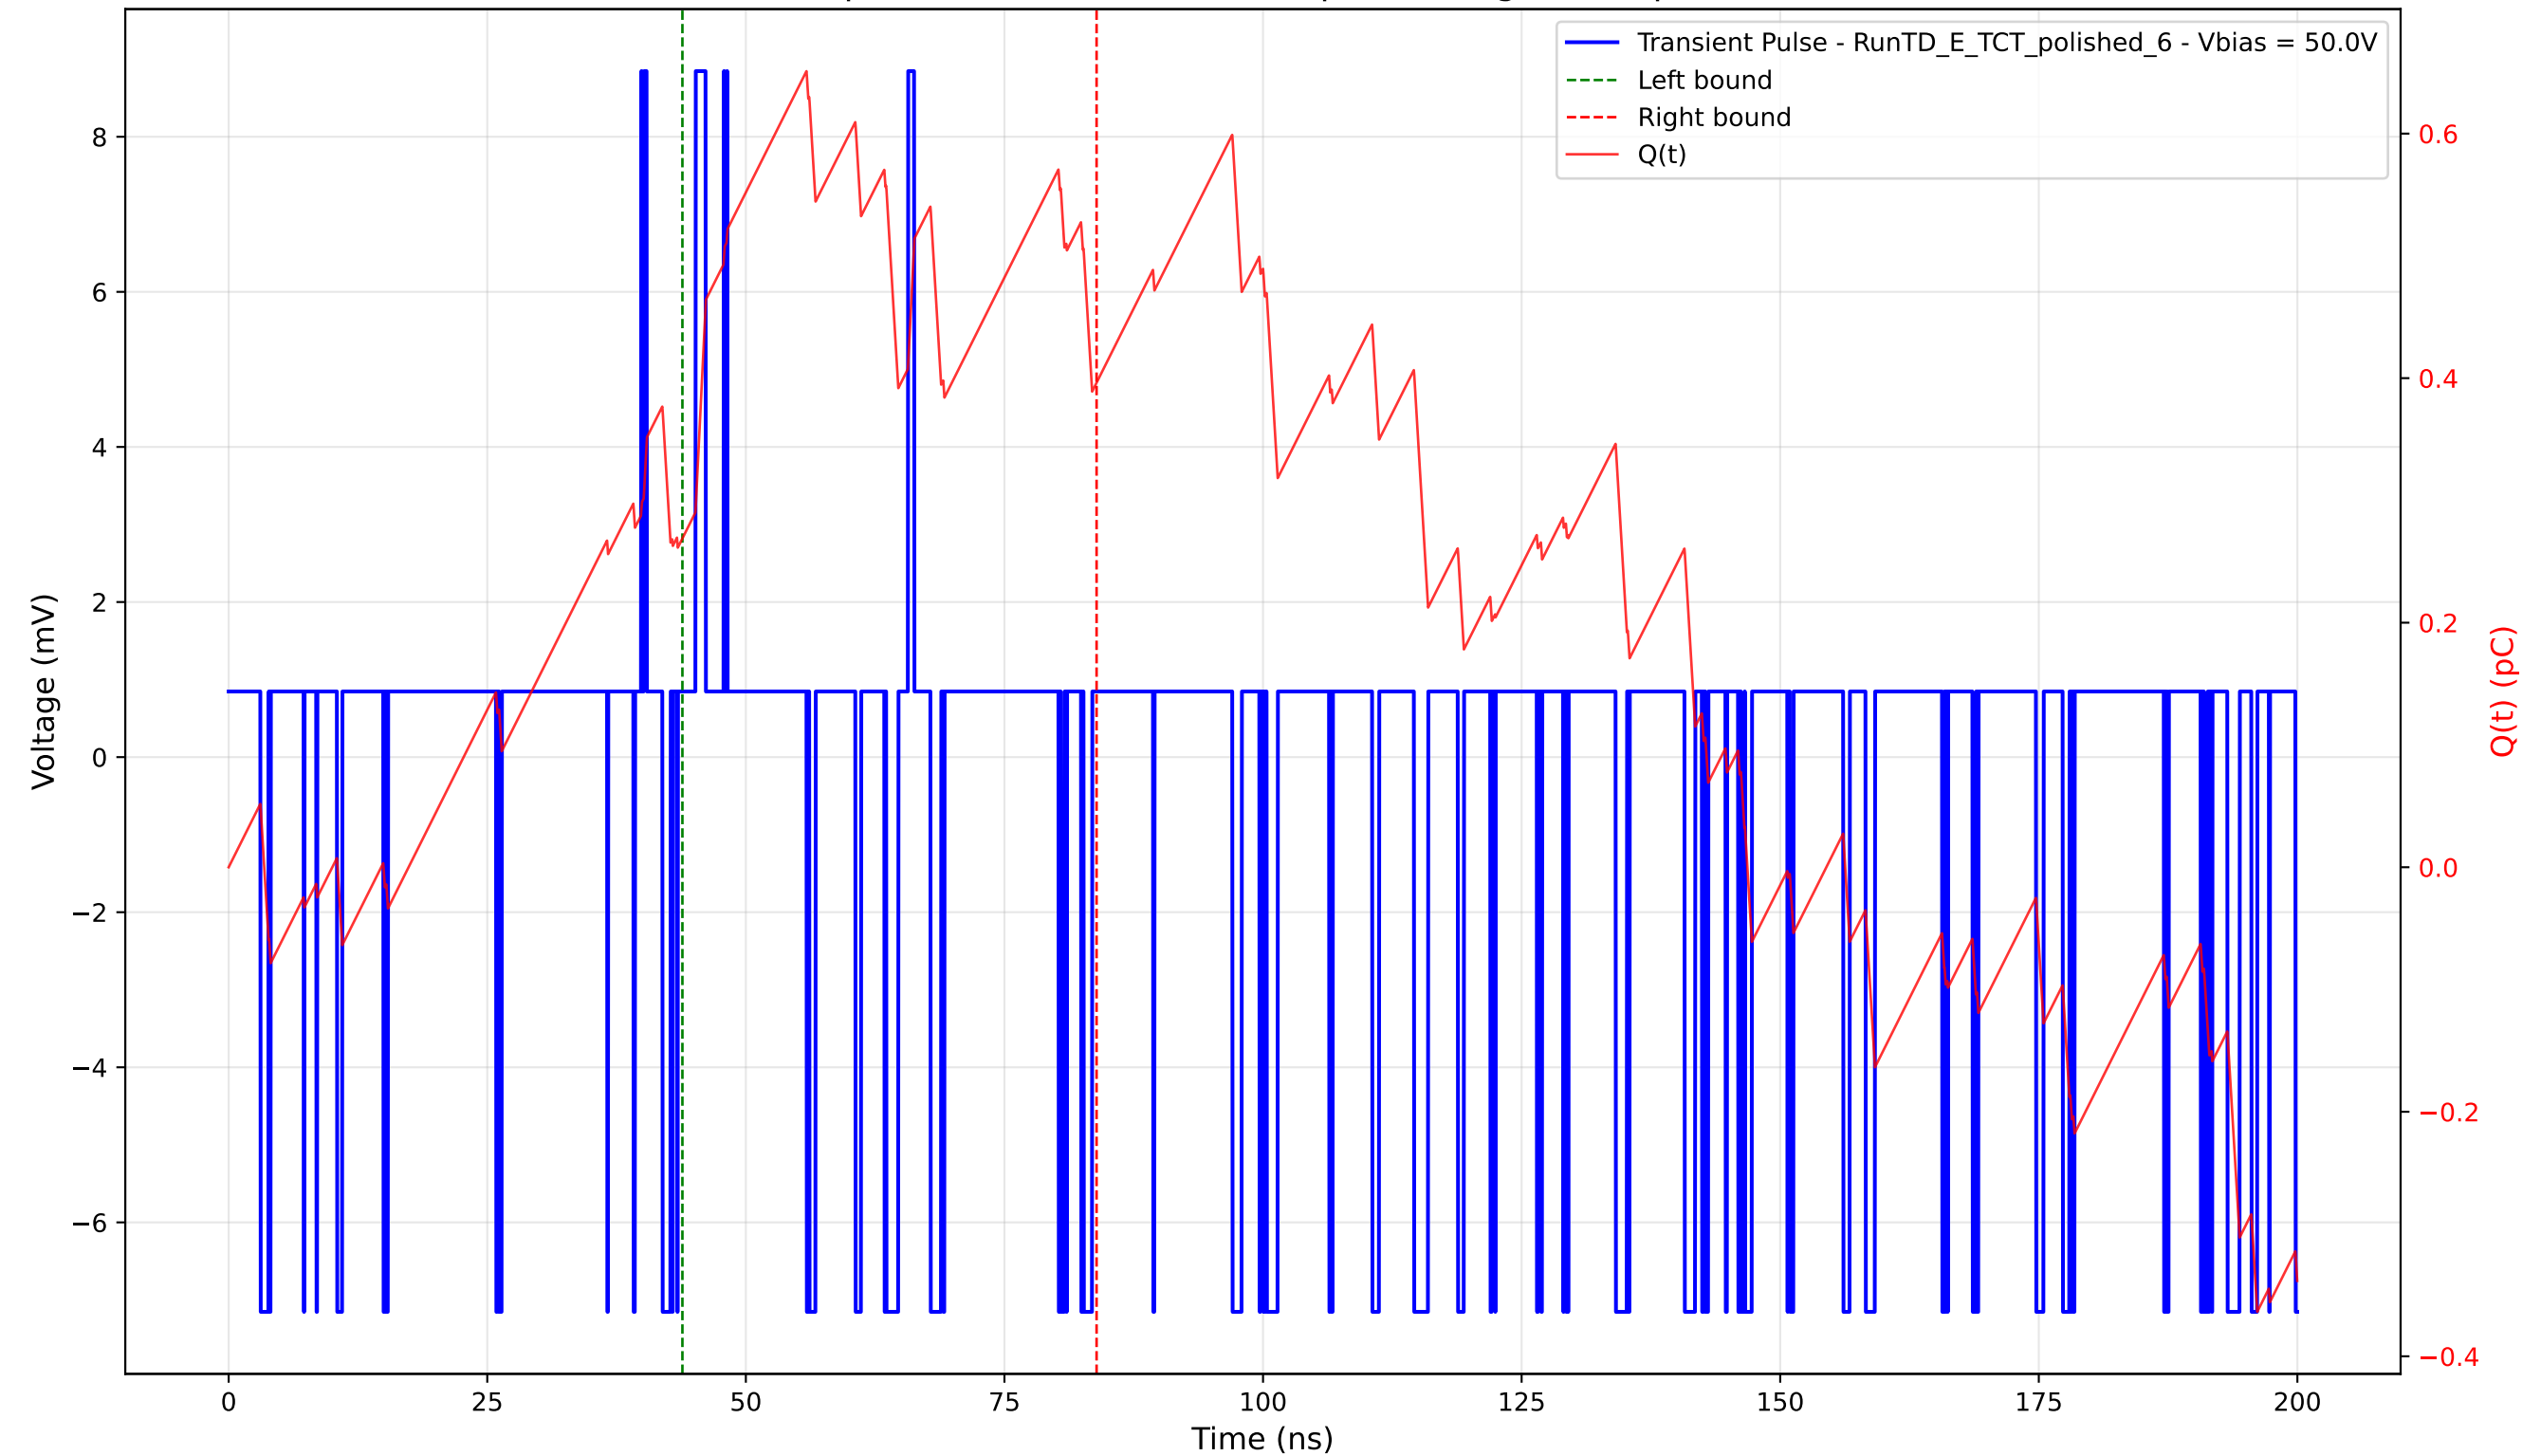

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.30 pC - Rise Time: 0.00 ns (N/A)

