


TCT Run 030 Summary

Parameter	Value
Run	Run030
Surface	N/A
Edge	x
Sample	TD_4004
Vbias (V)	250.0
DAC (%)	56.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\Run030
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

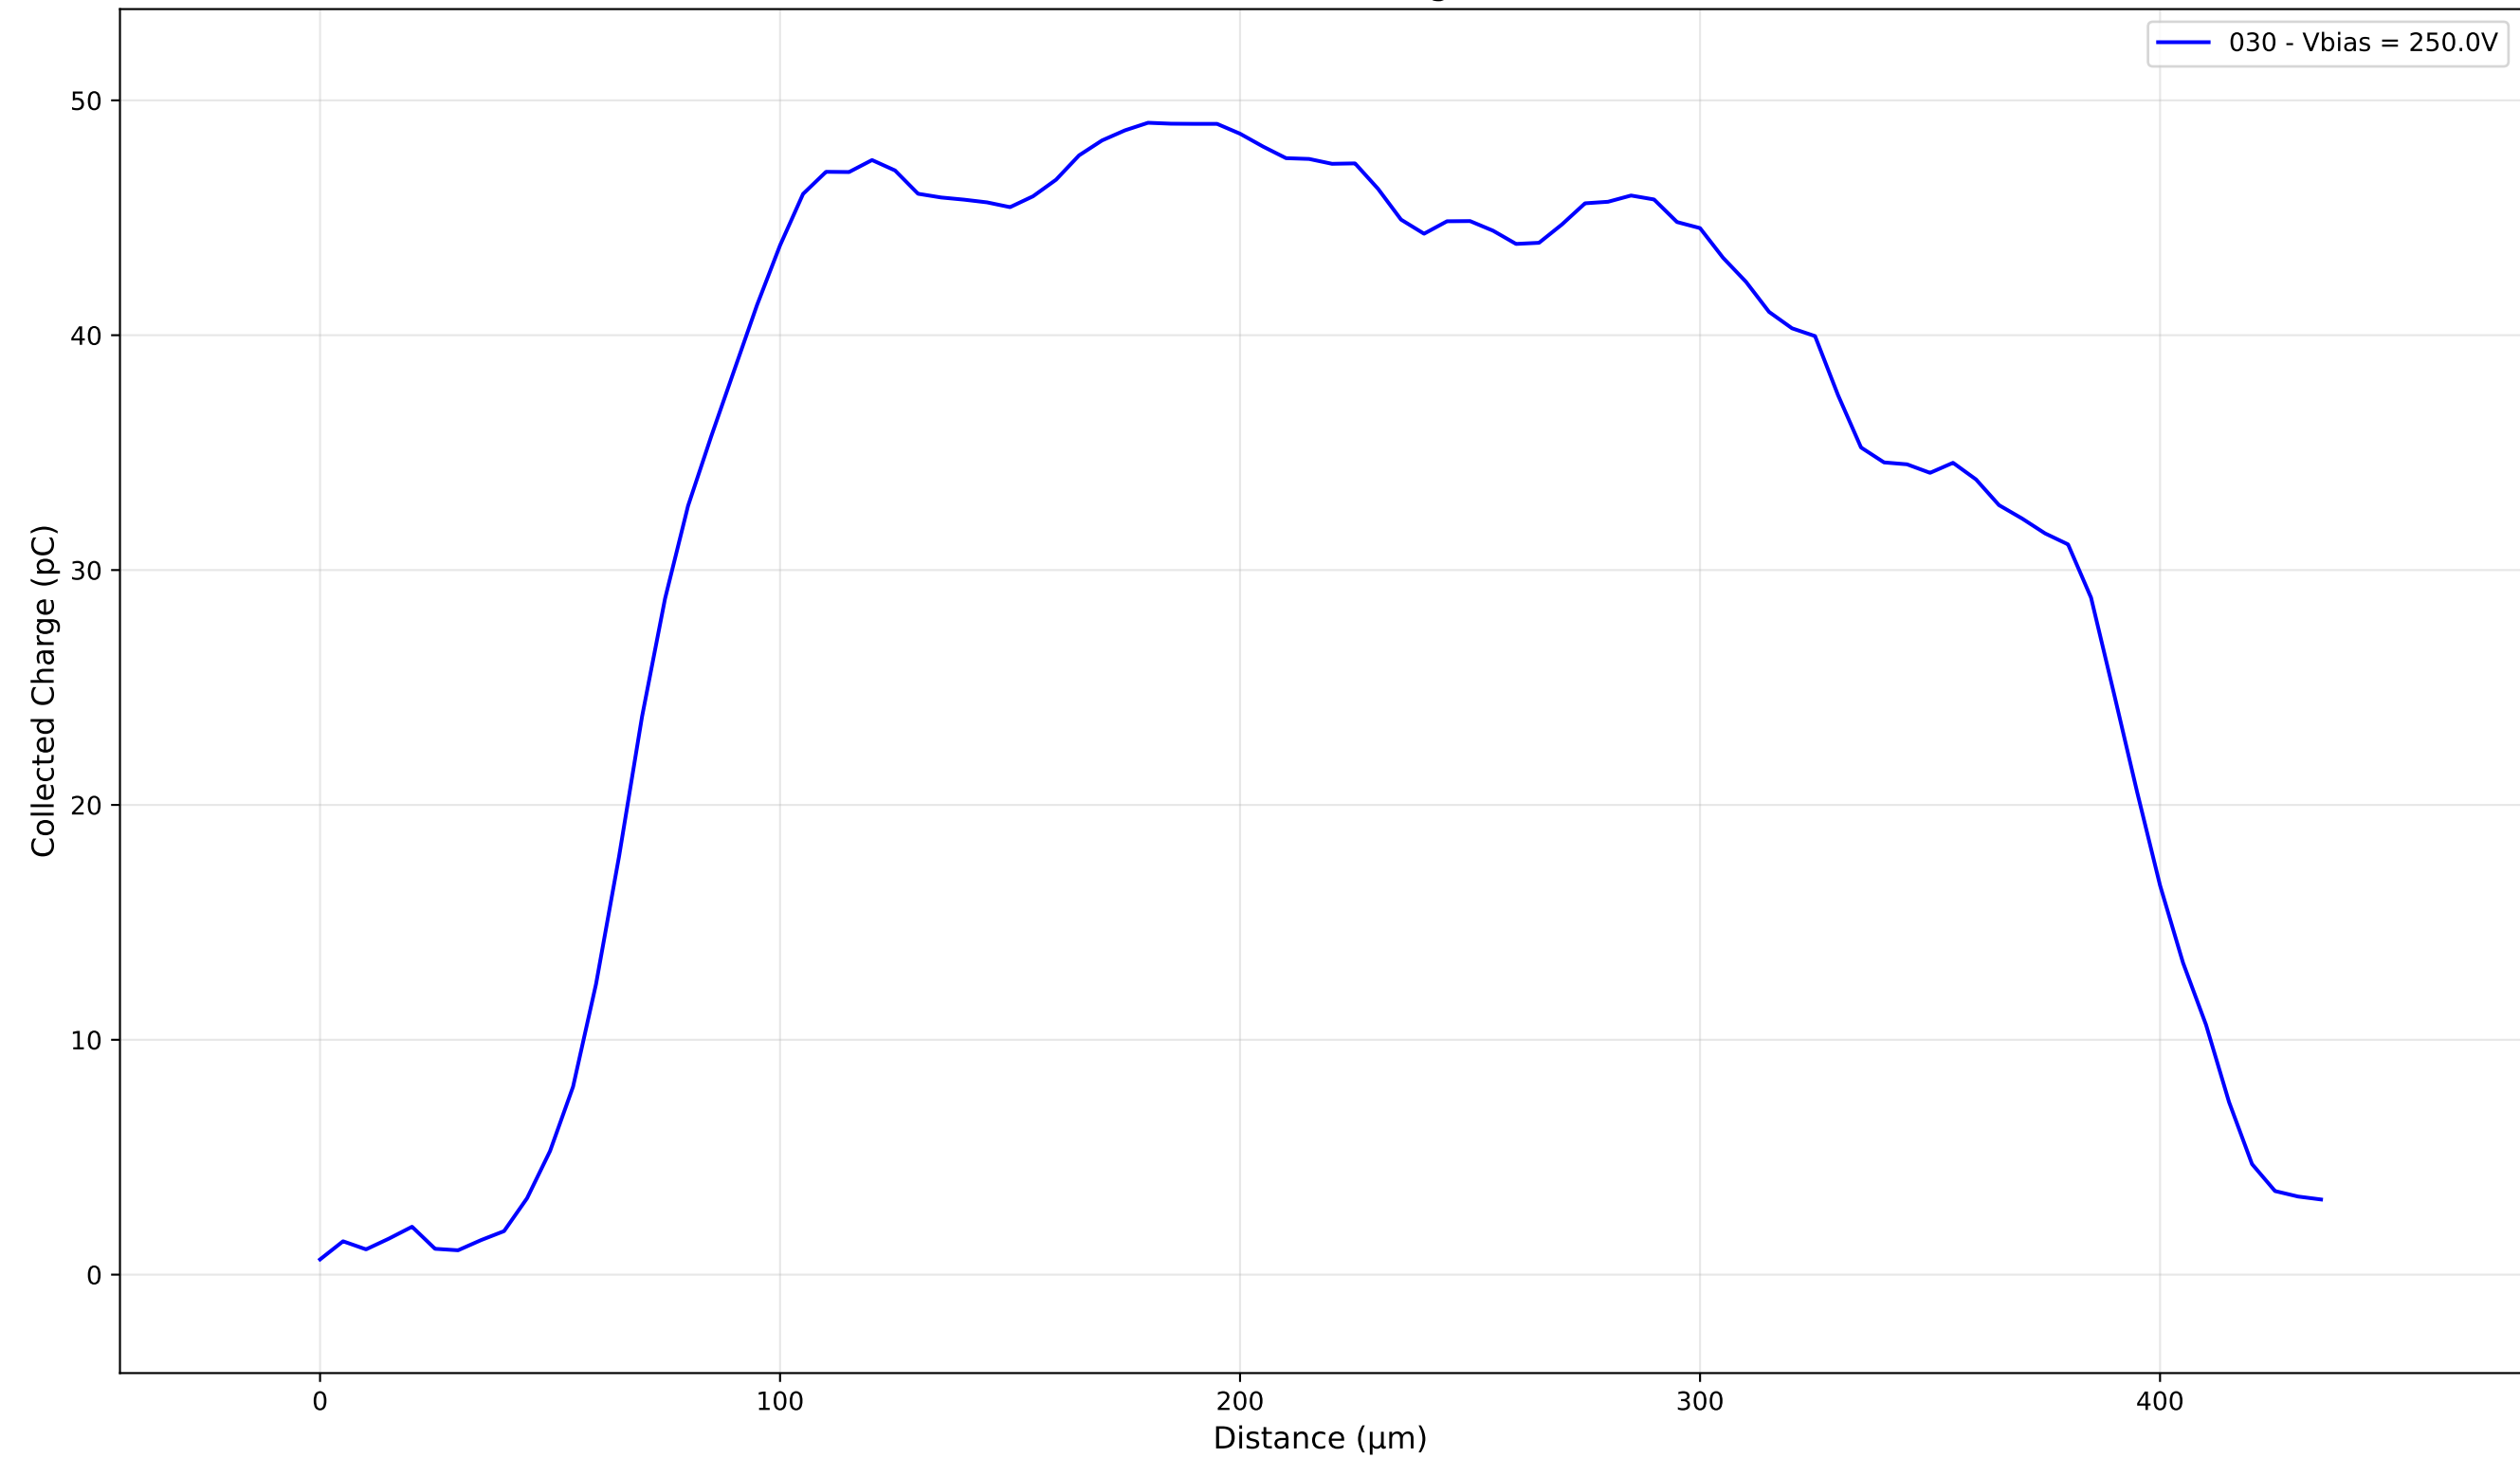

Collected Charge

030 - Vbias = 250.0V

Collected Charge [a.u.]

1.0

0.8

0.6

0.4

0.2

0.0

0


100

200


300

400


Distance (μm)

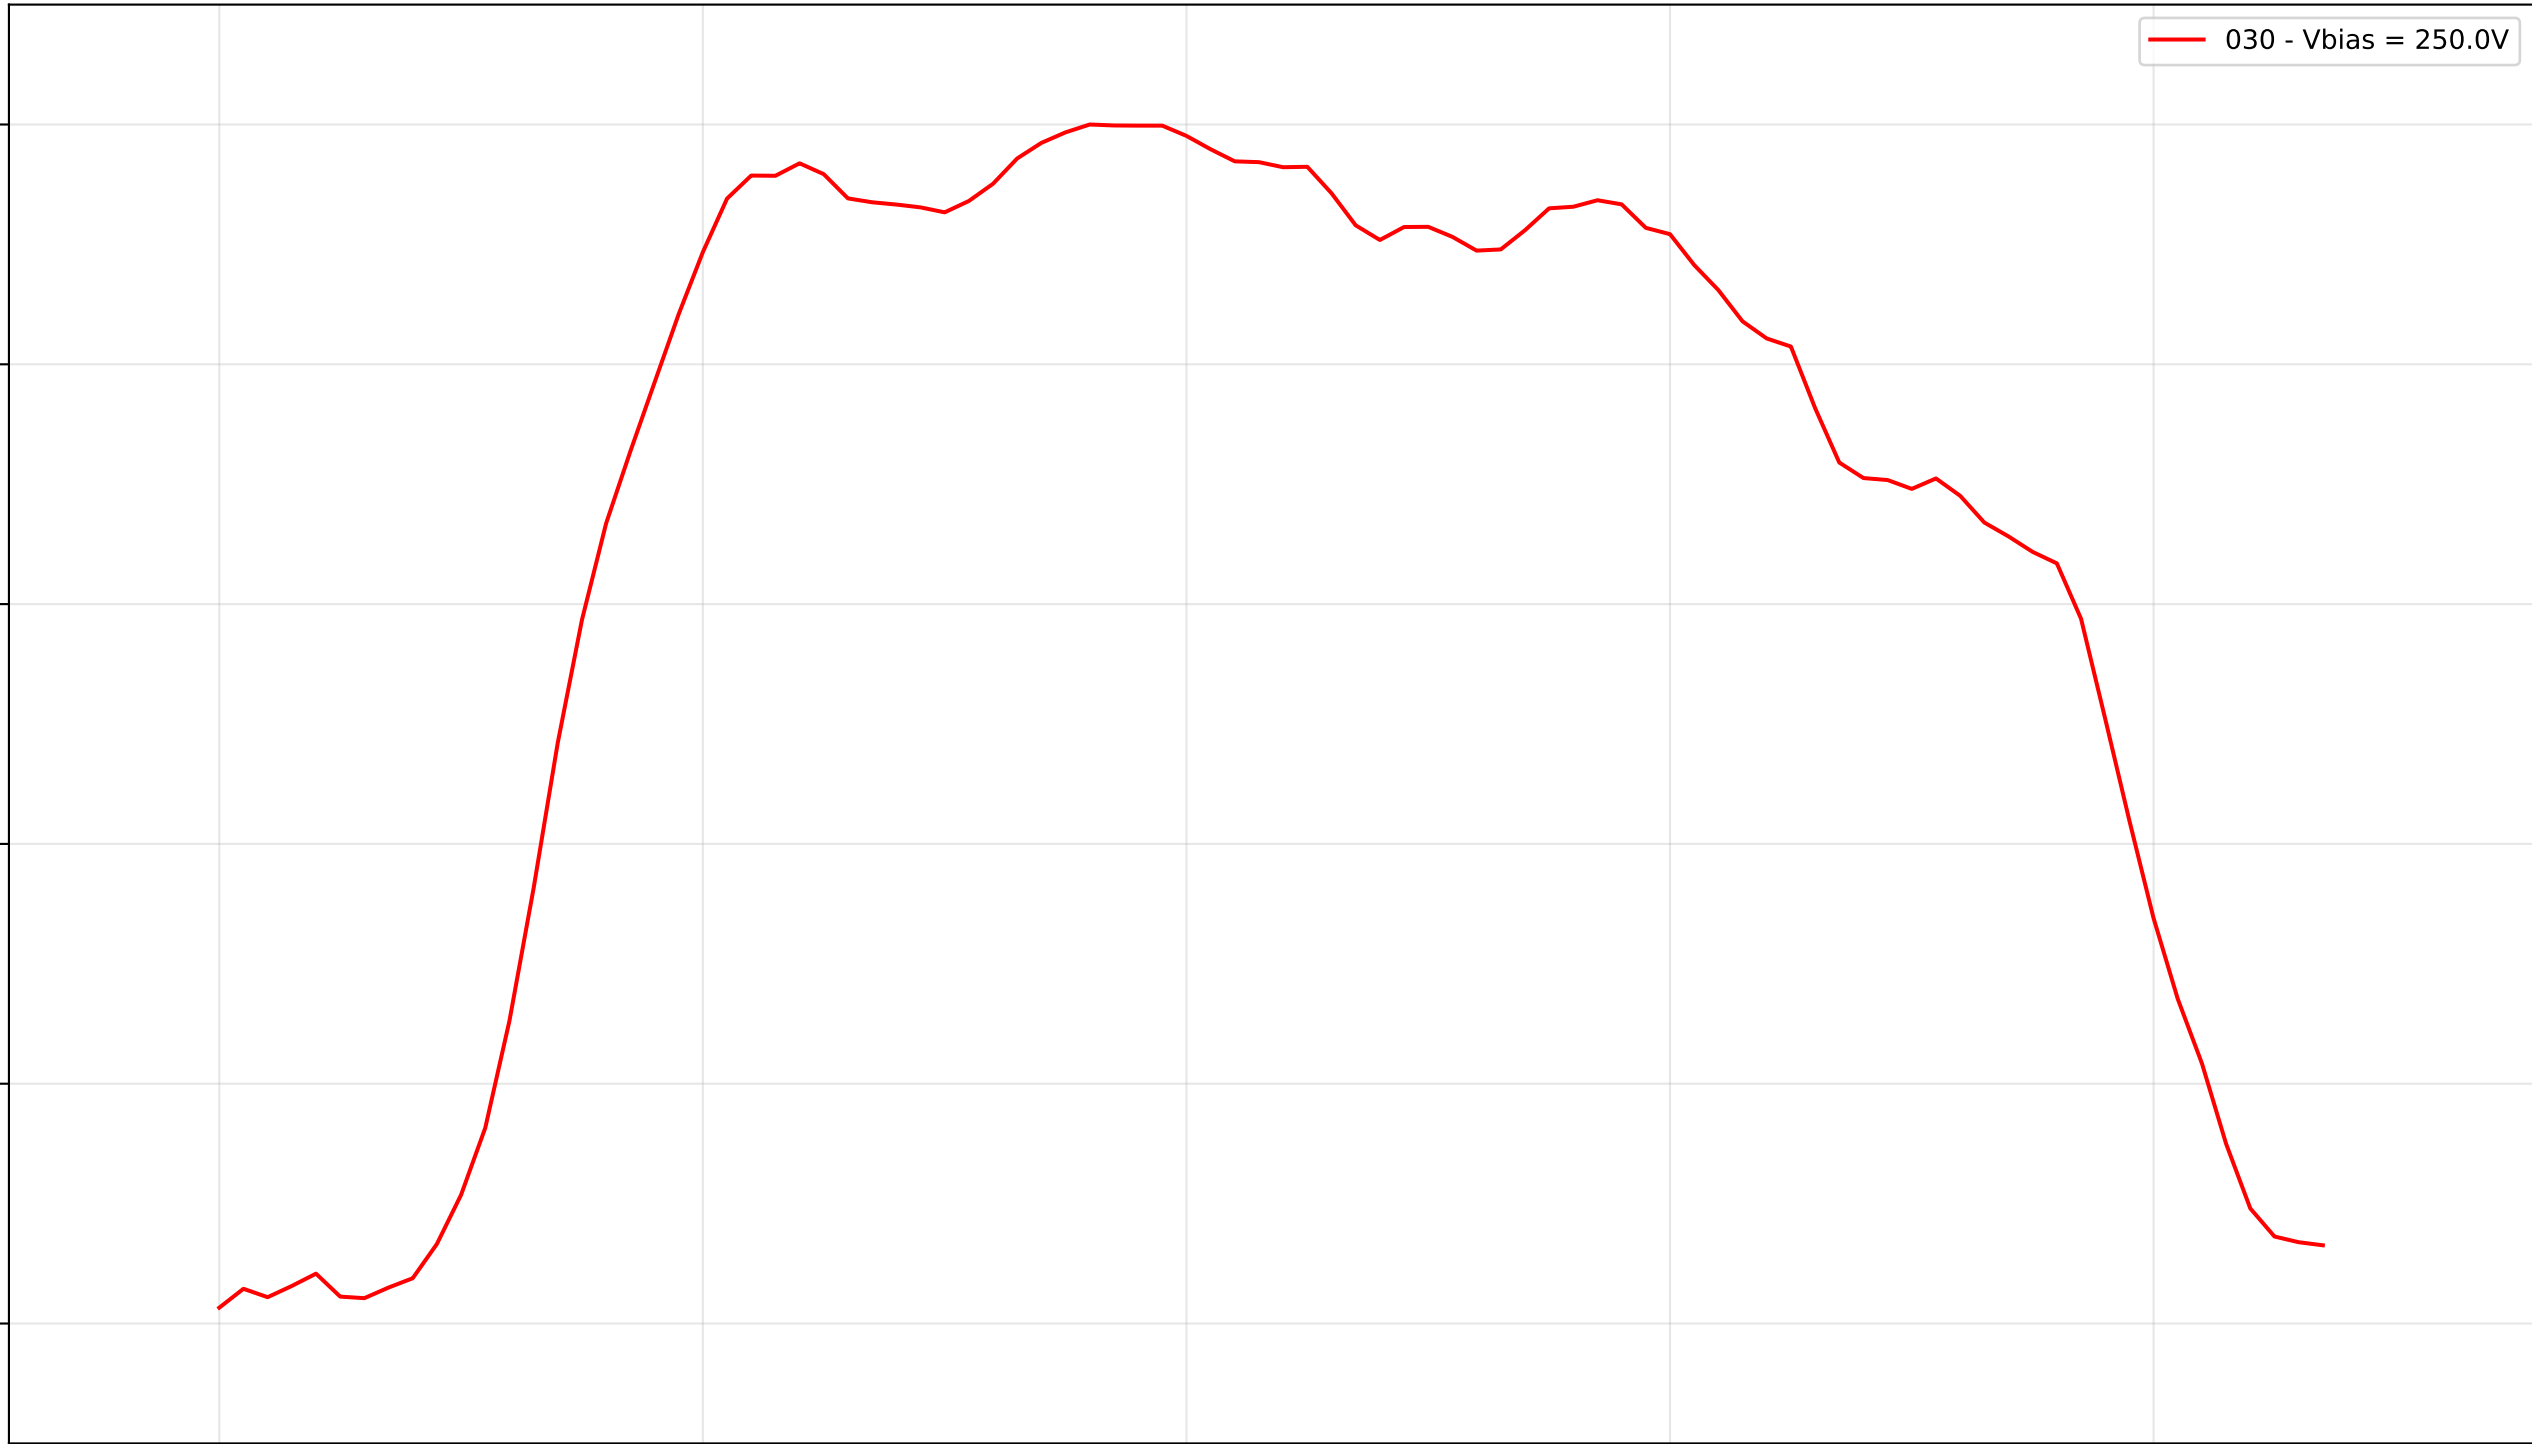


Rise Time

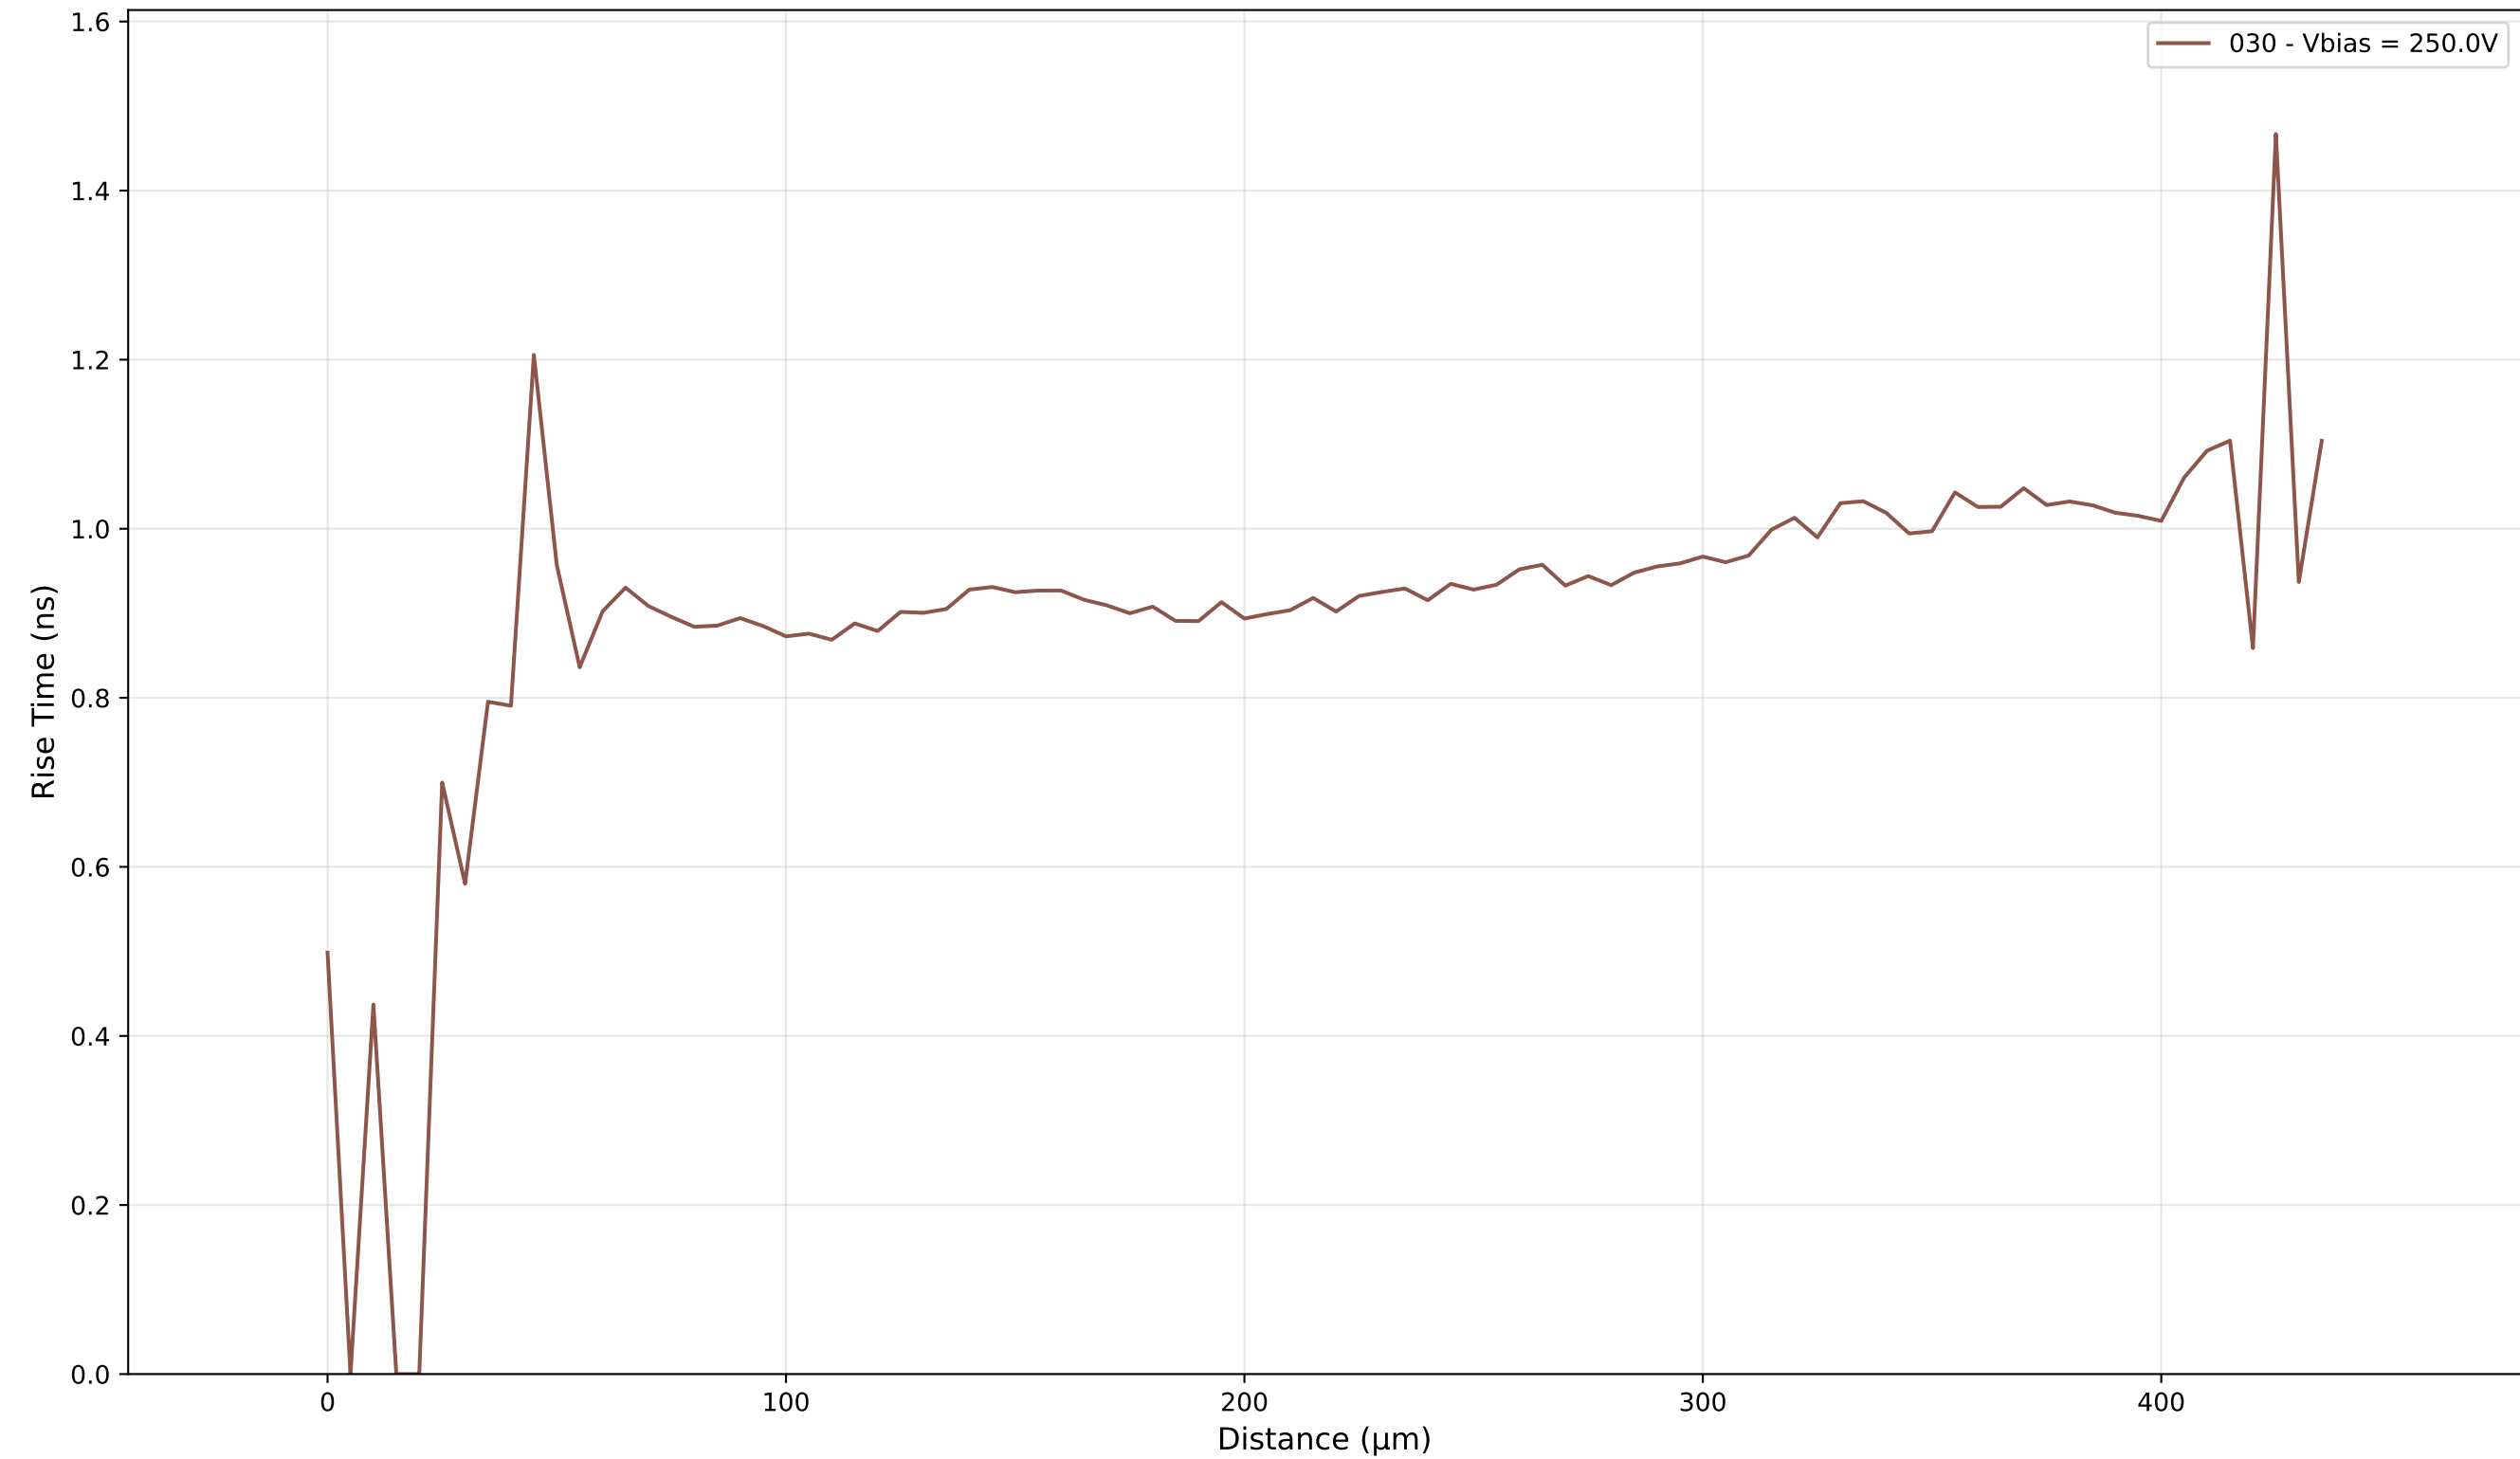

Amplitude

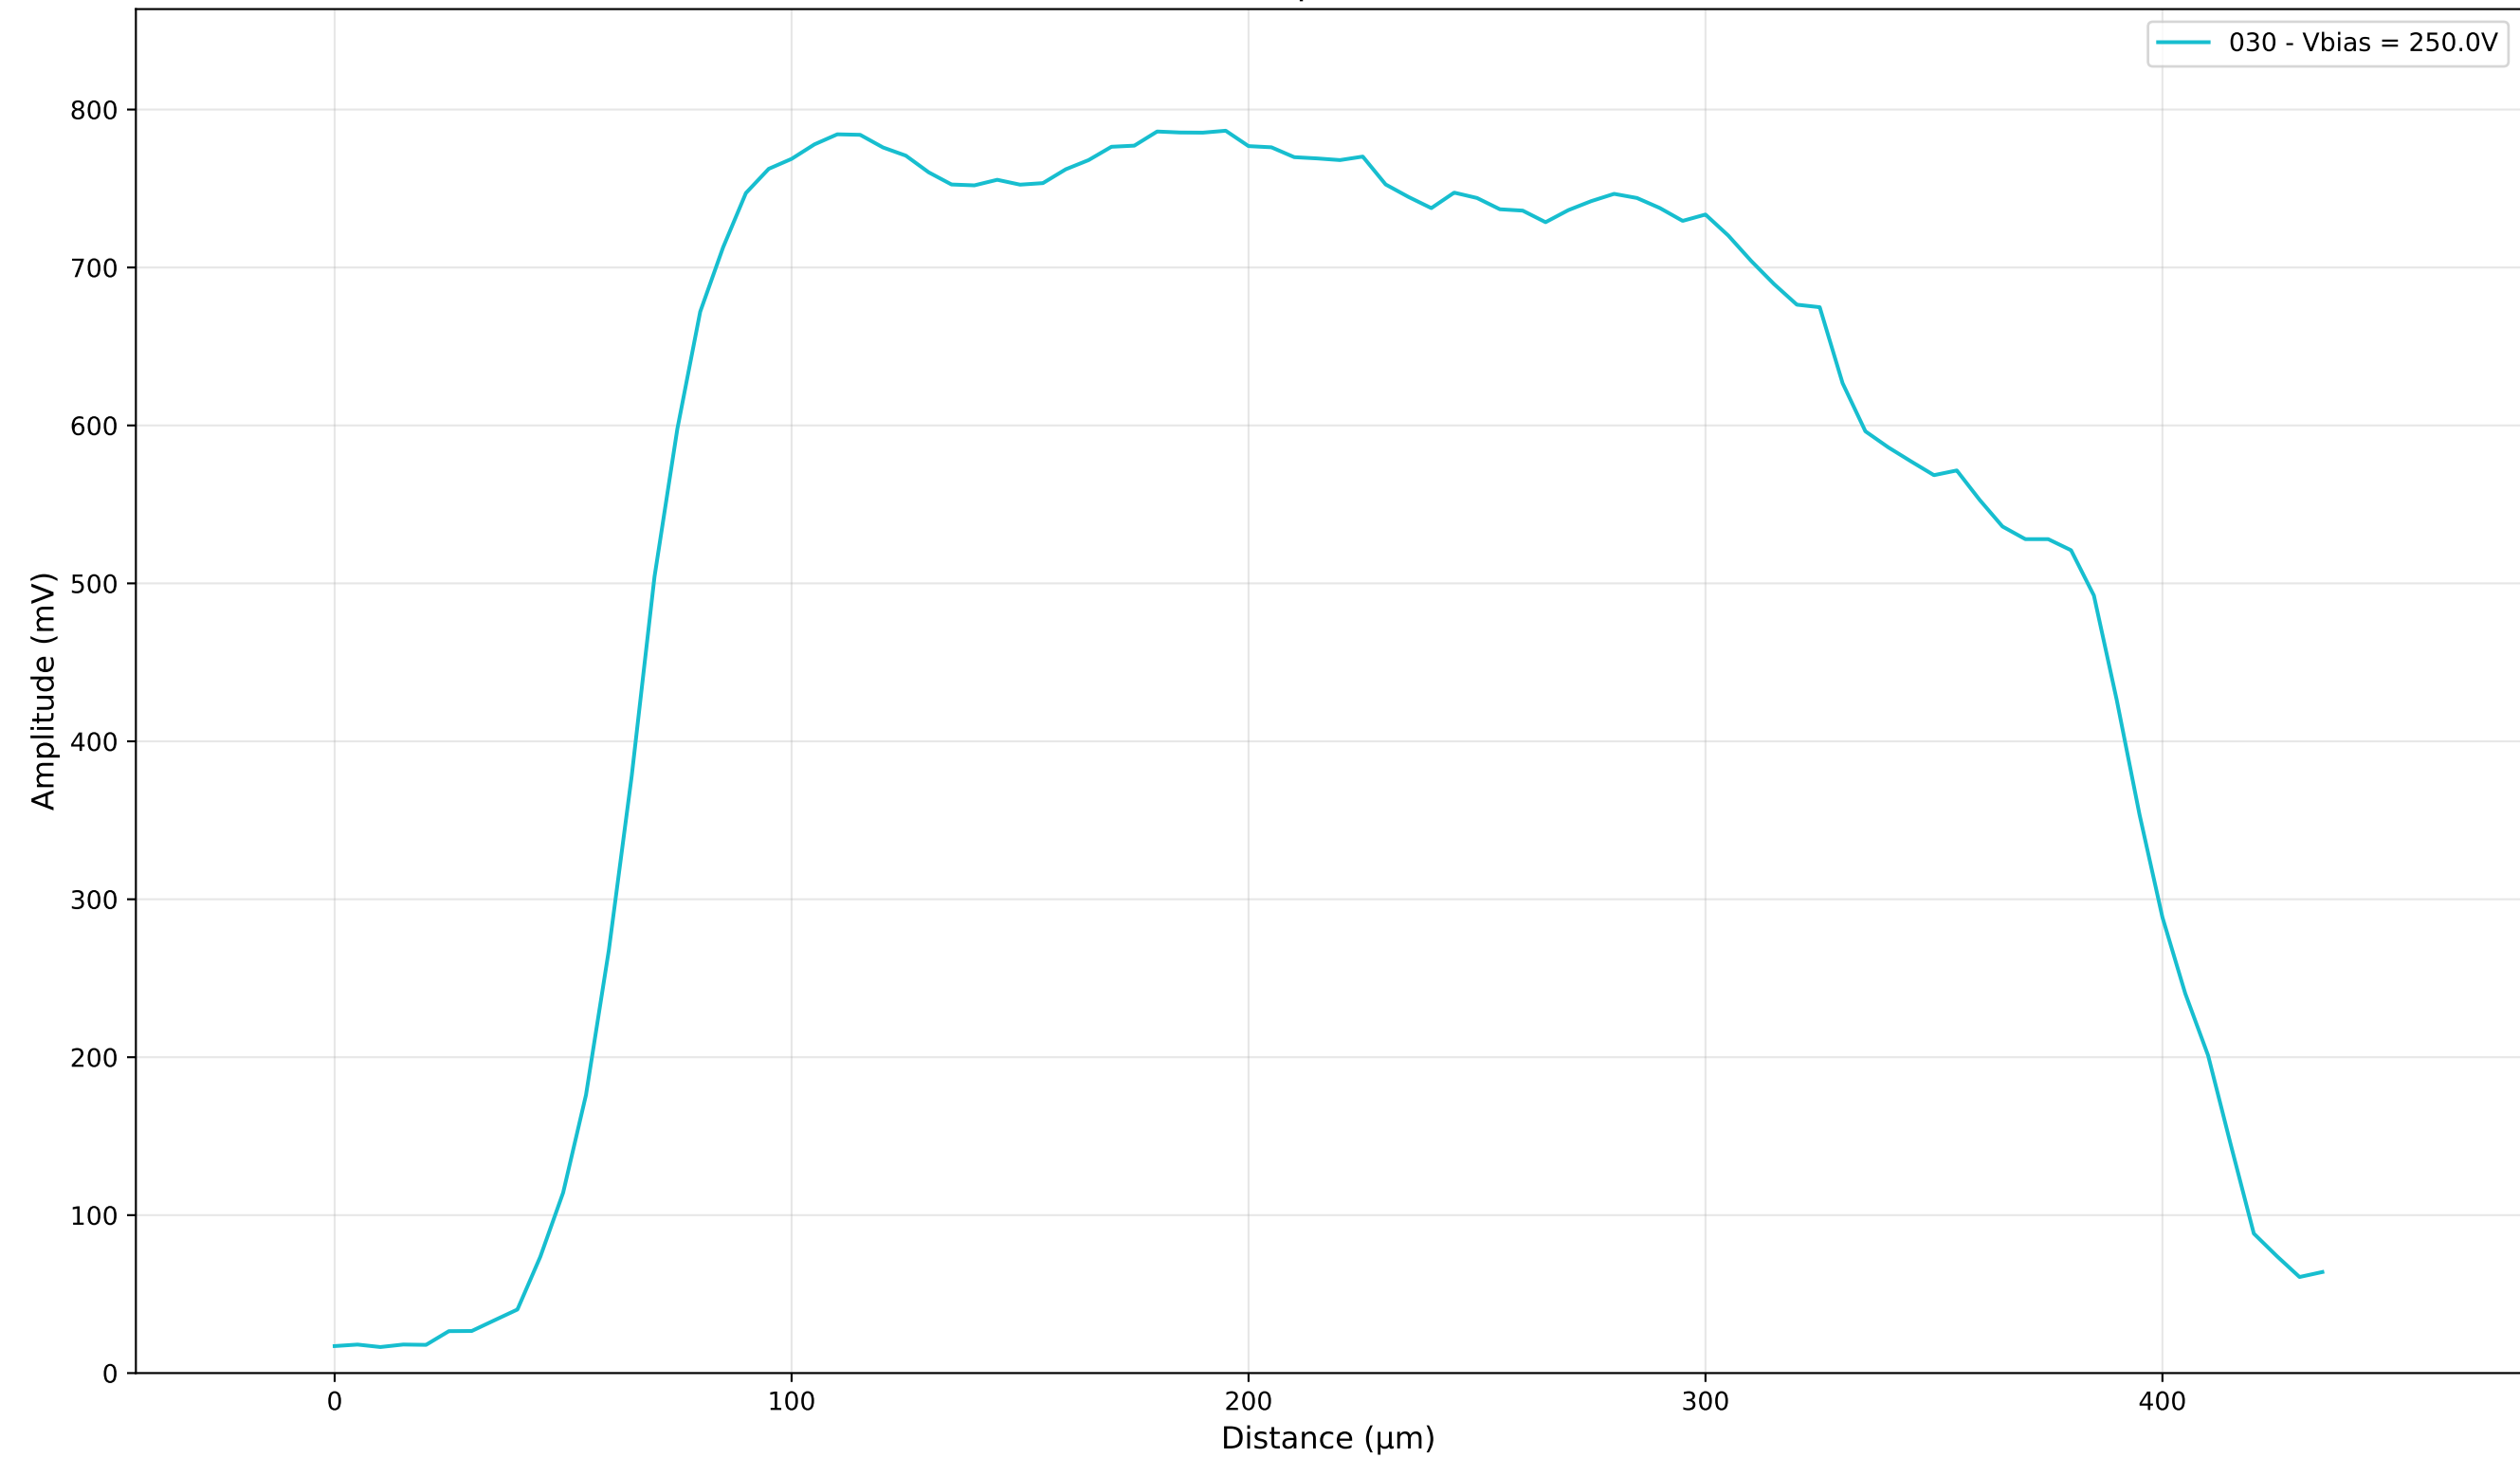


FWHM

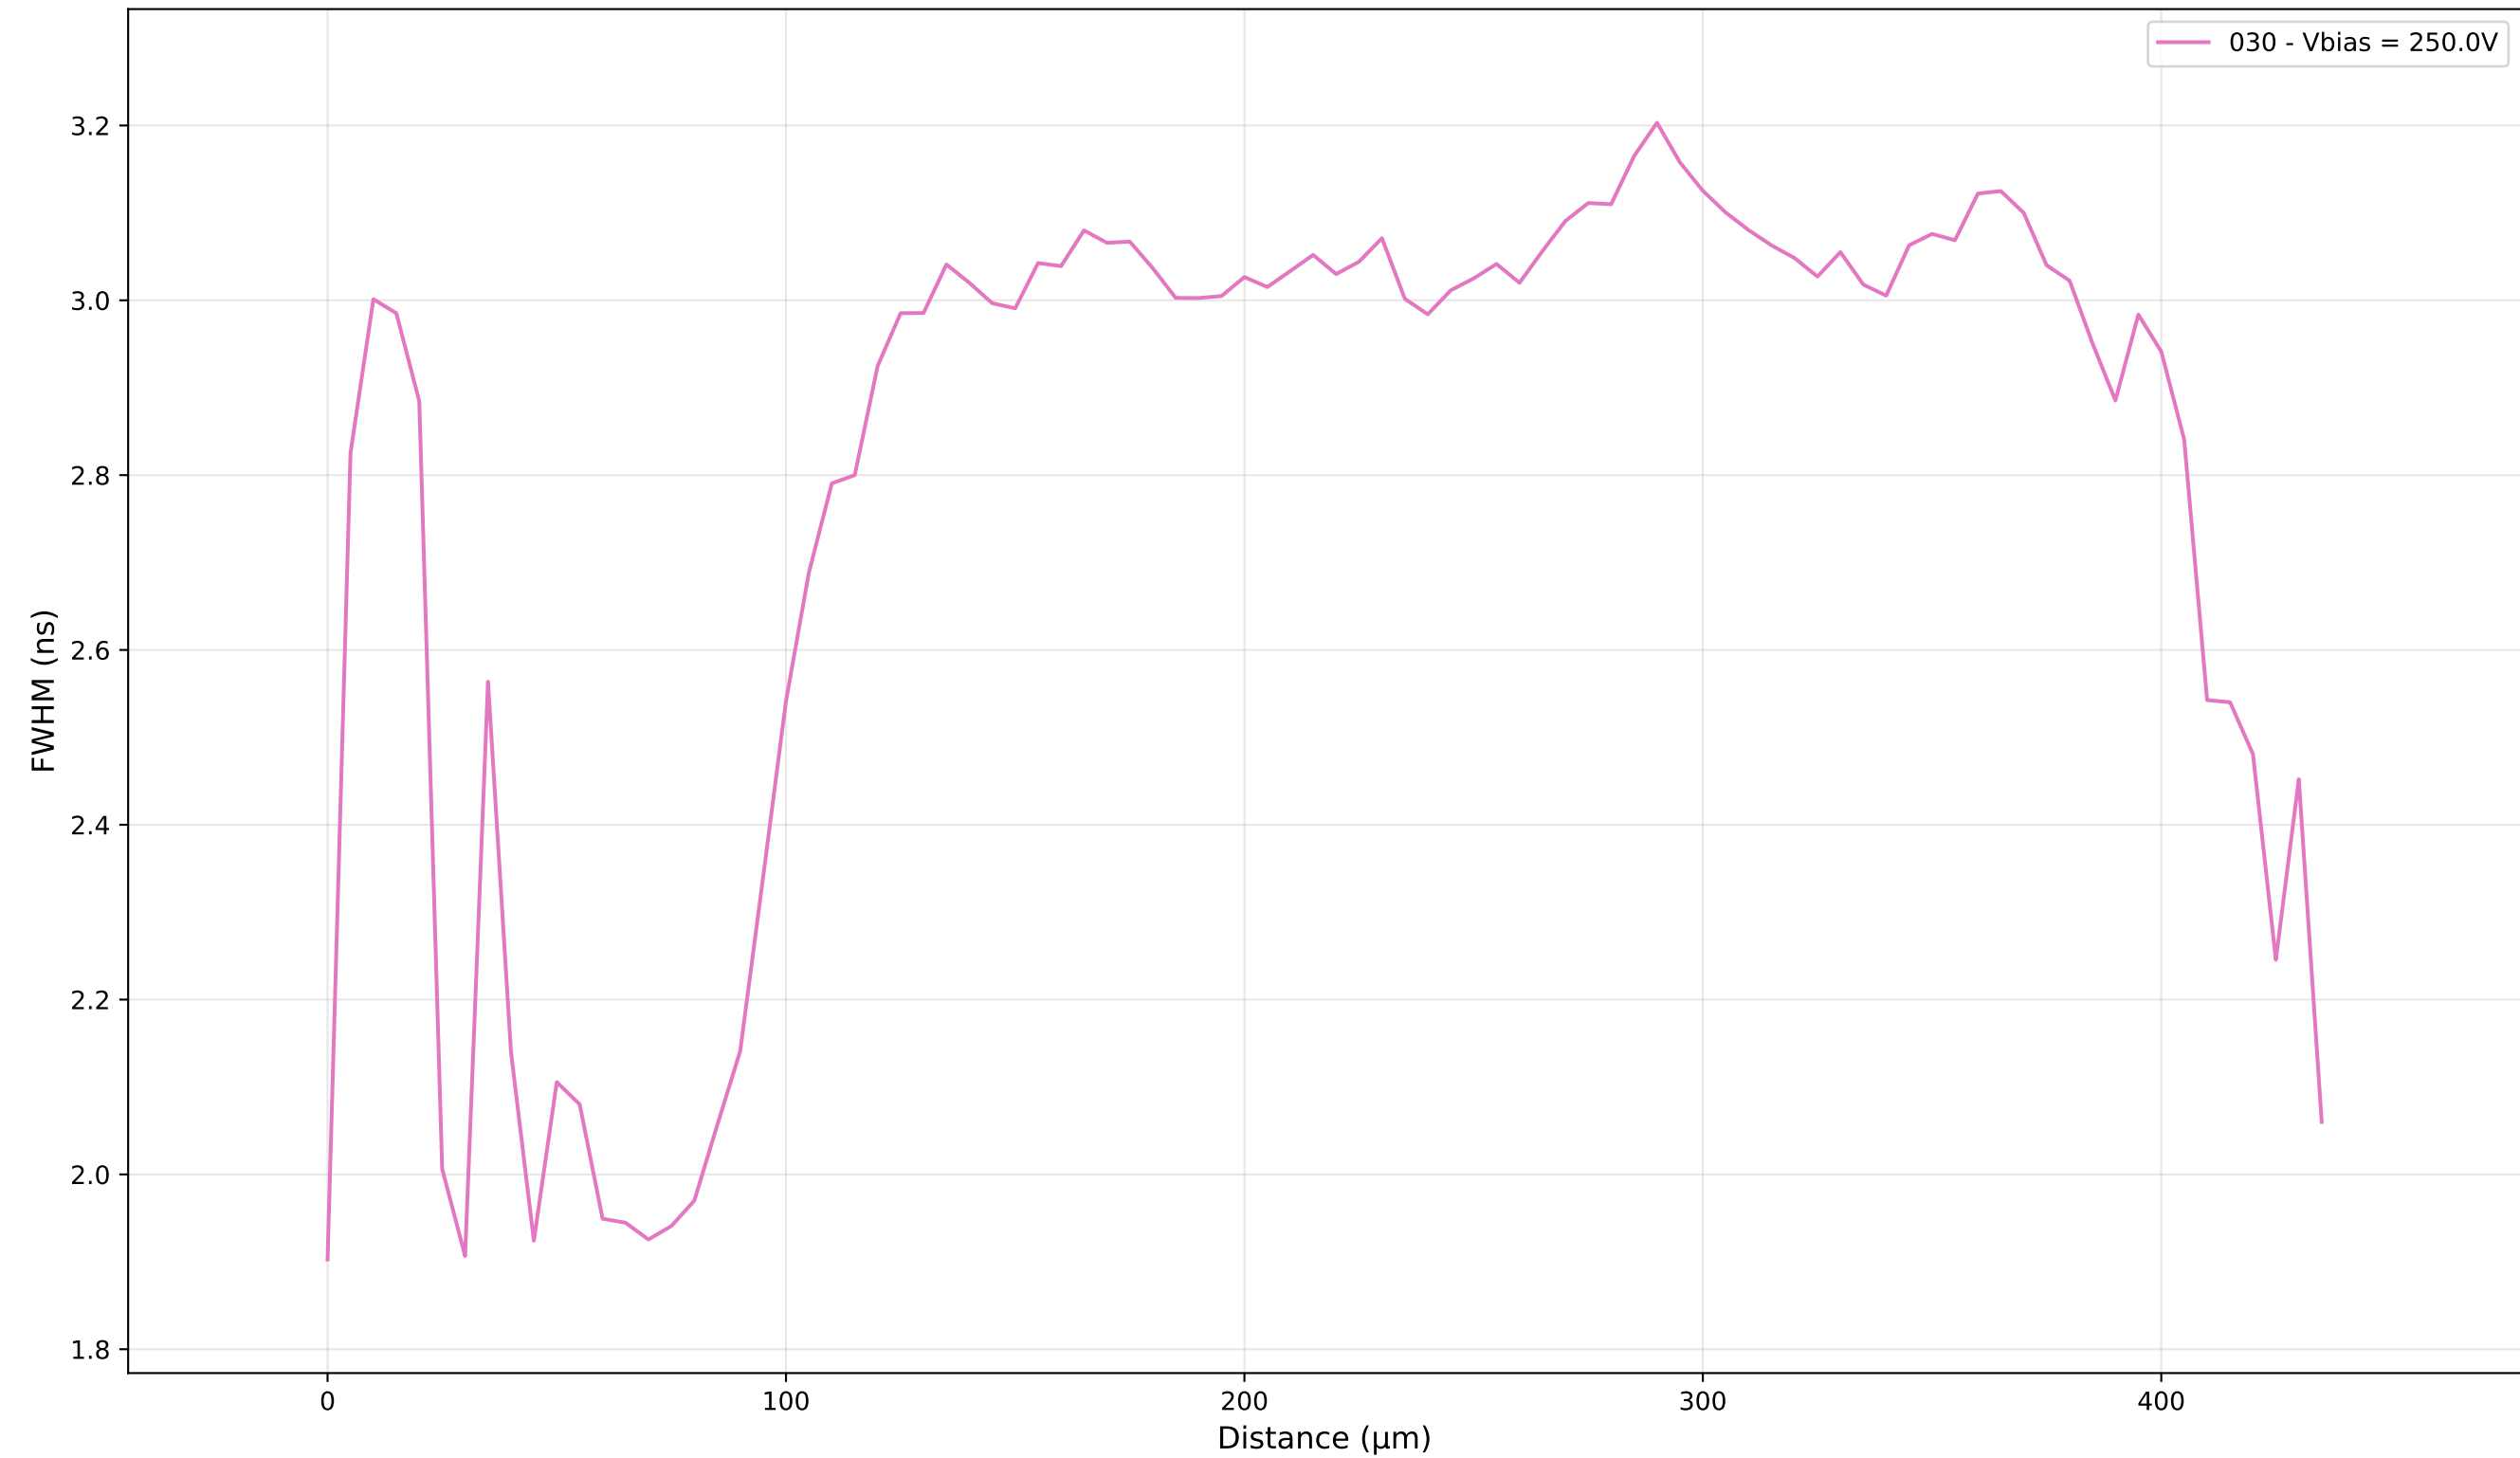

Transient Pulse - Sample: TD_4004 - Position: 0.0 μm - Charge: 0.65 pC - Rise Time: 0.50 ns




Transient Pulse - Sample: TD_4004 - Position: 5.0 μ m - Charge: 1.42 pC - Rise Time: 0.00 ns (N/A)

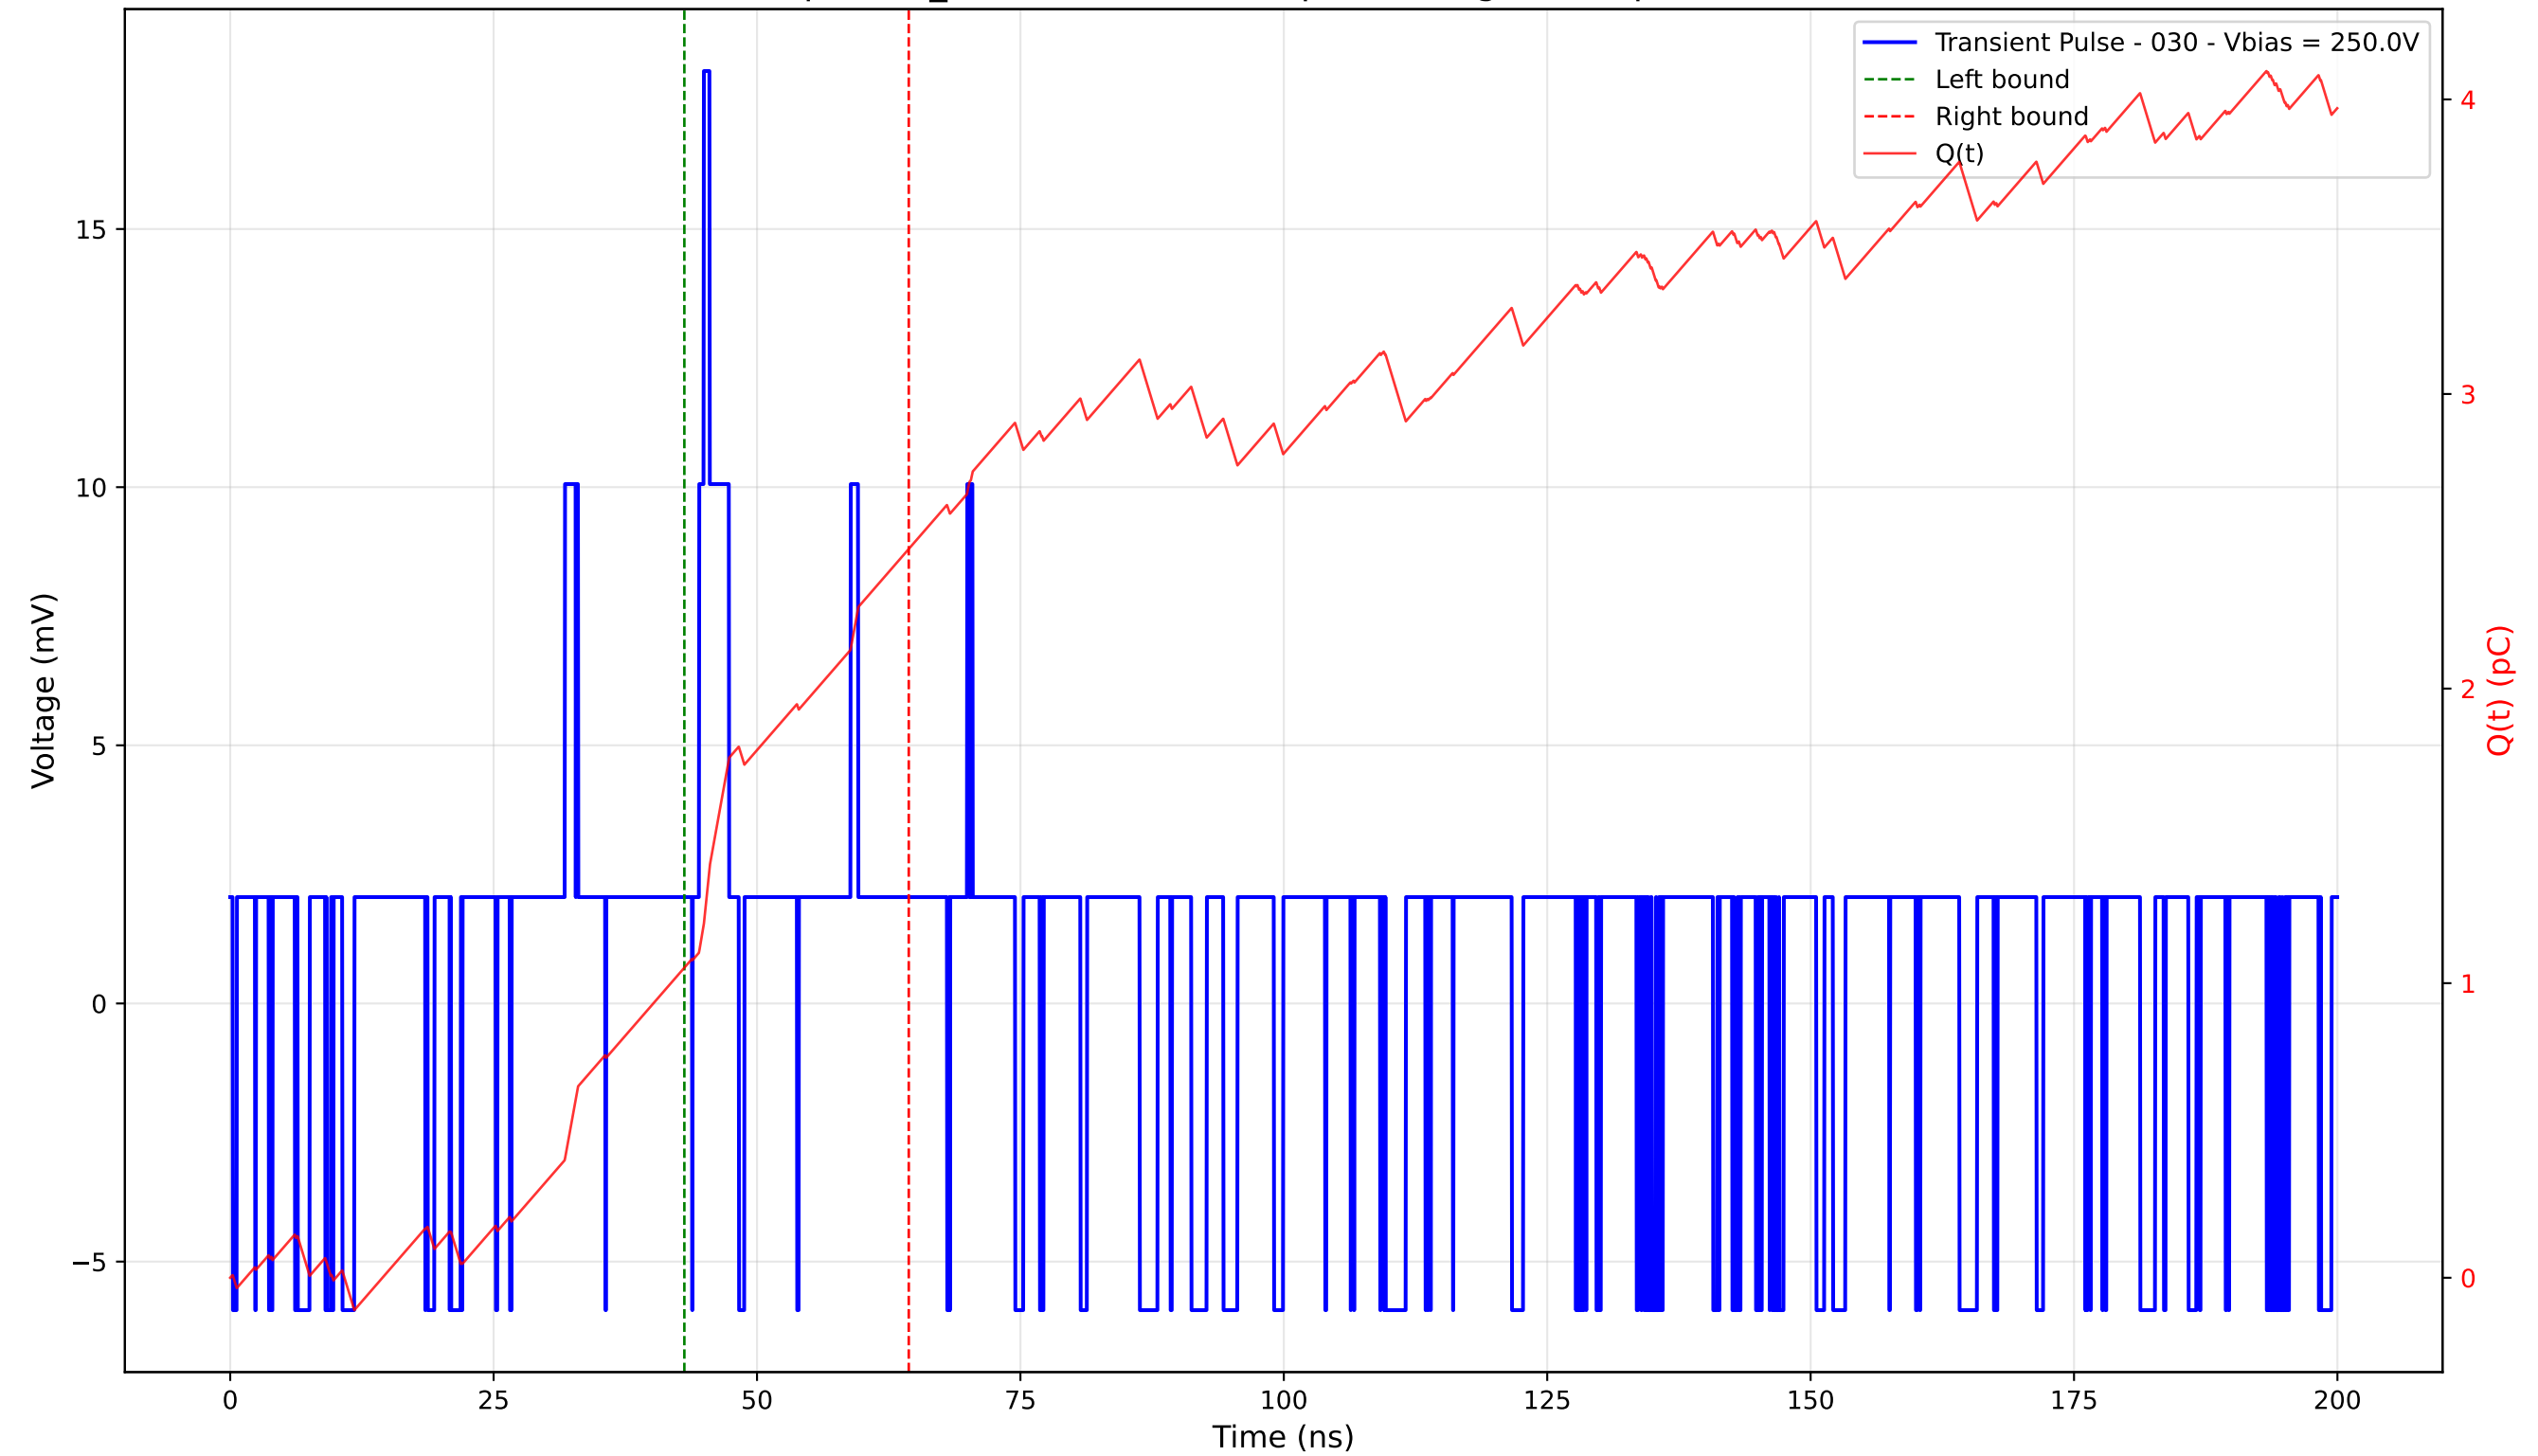


Transient Pulse - Sample: TD_4004 - Position: 10.0 μm - Charge: 1.08 pC - Rise Time: 0.44 ns




Transient Pulse - Sample: TD_4004 - Position: 15.0 μm - Charge: 1.54 pC - Rise Time: 0.00 ns (N/A)

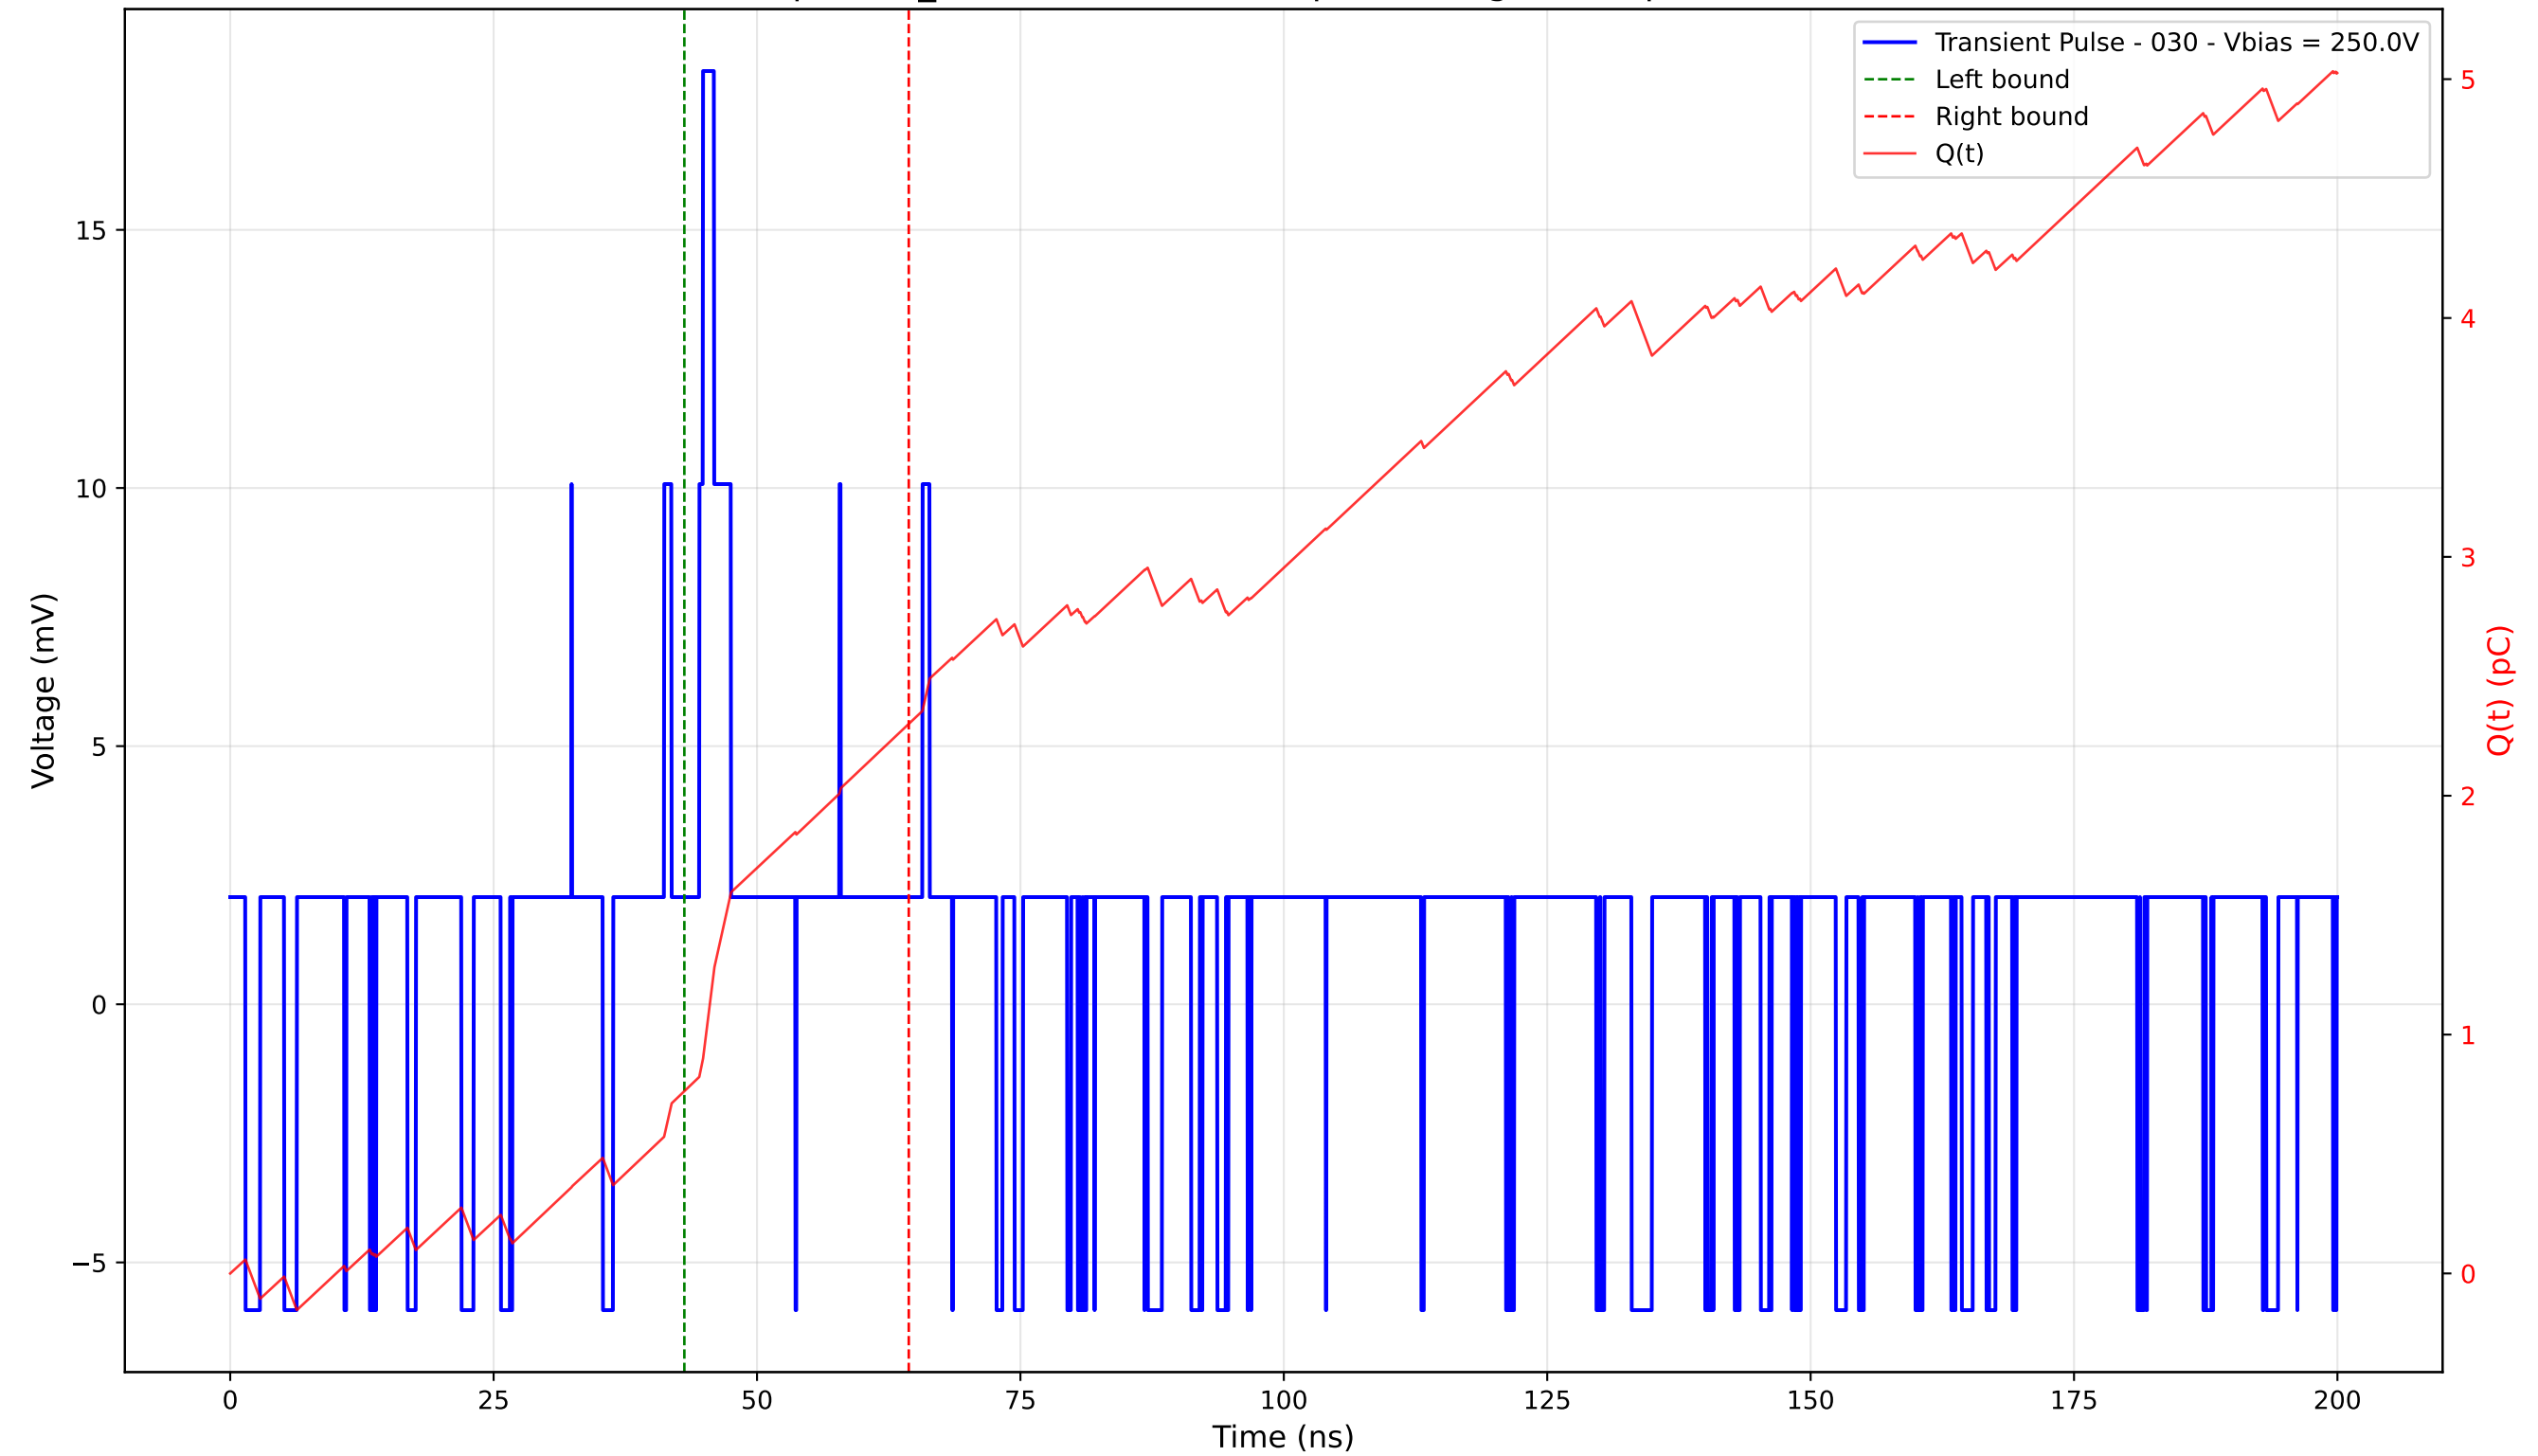


Transient Pulse - Sample: TD_4004 - Position: 20.0 μm - Charge: 2.04 pC - Rise Time: 0.00 ns (N/A)

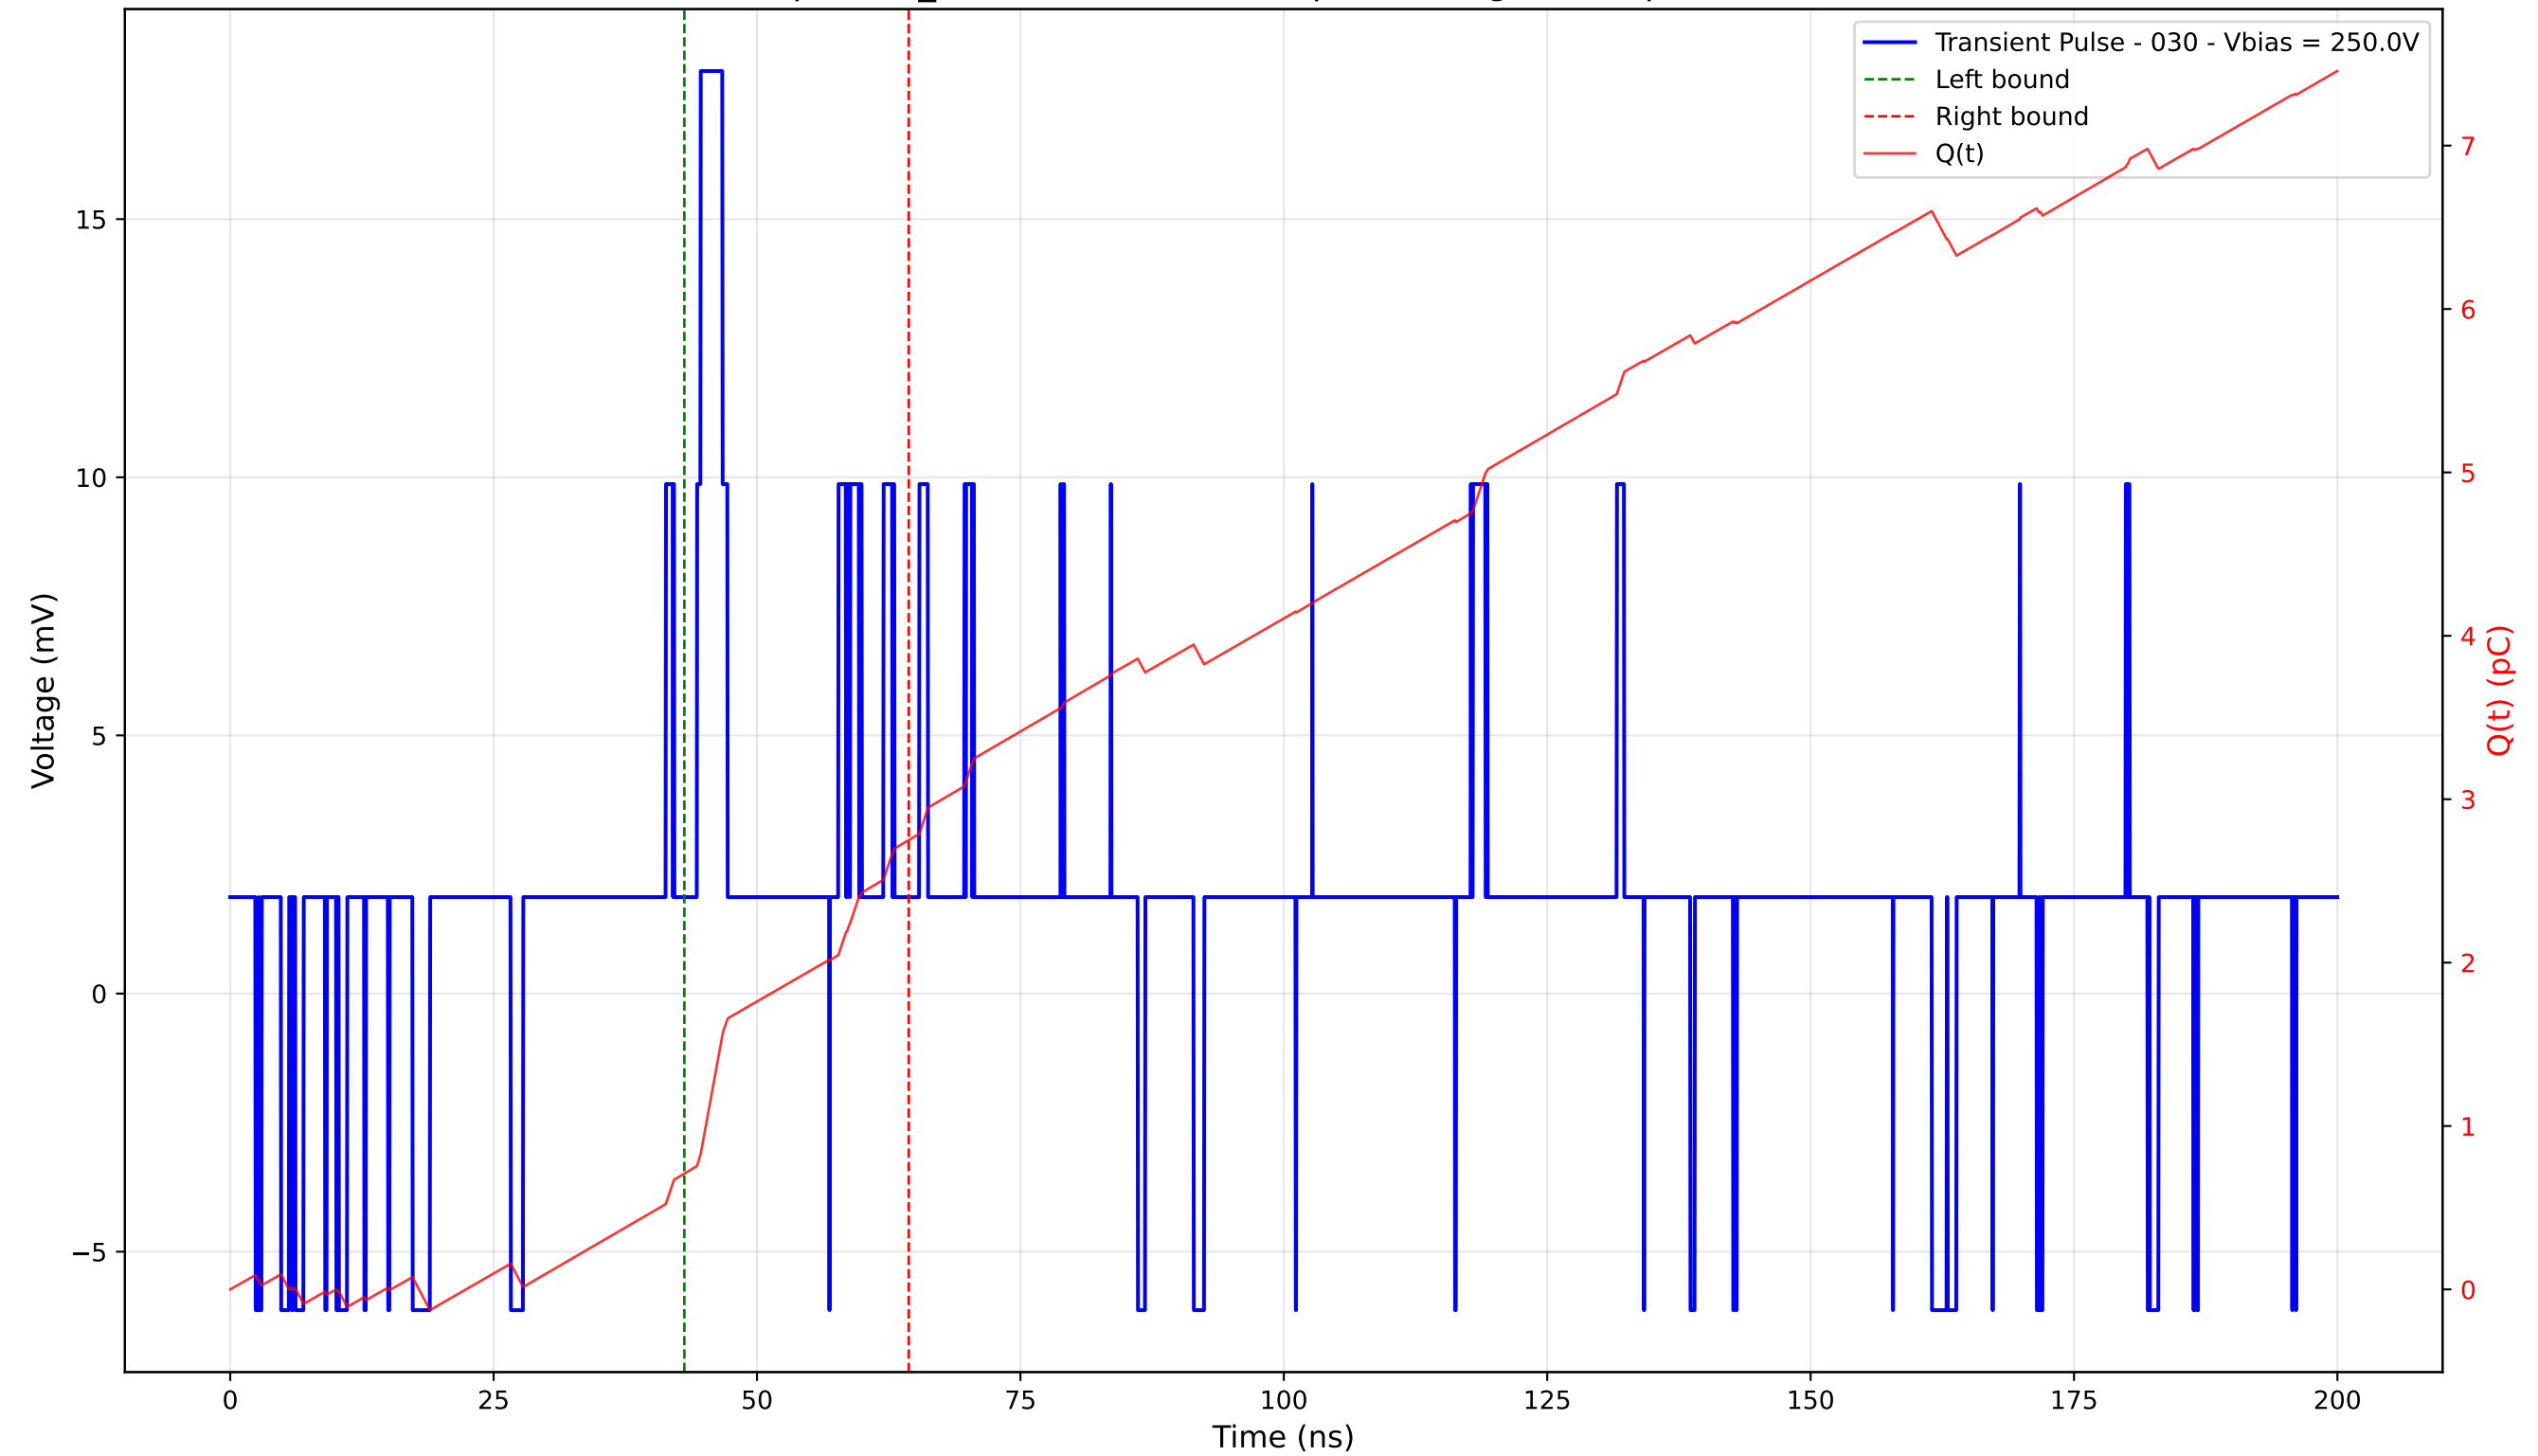


Transient Pulse - Sample: TD_4004 - Position: 25.0 μm - Charge: 1.10 pC - Rise Time: 0.70 ns

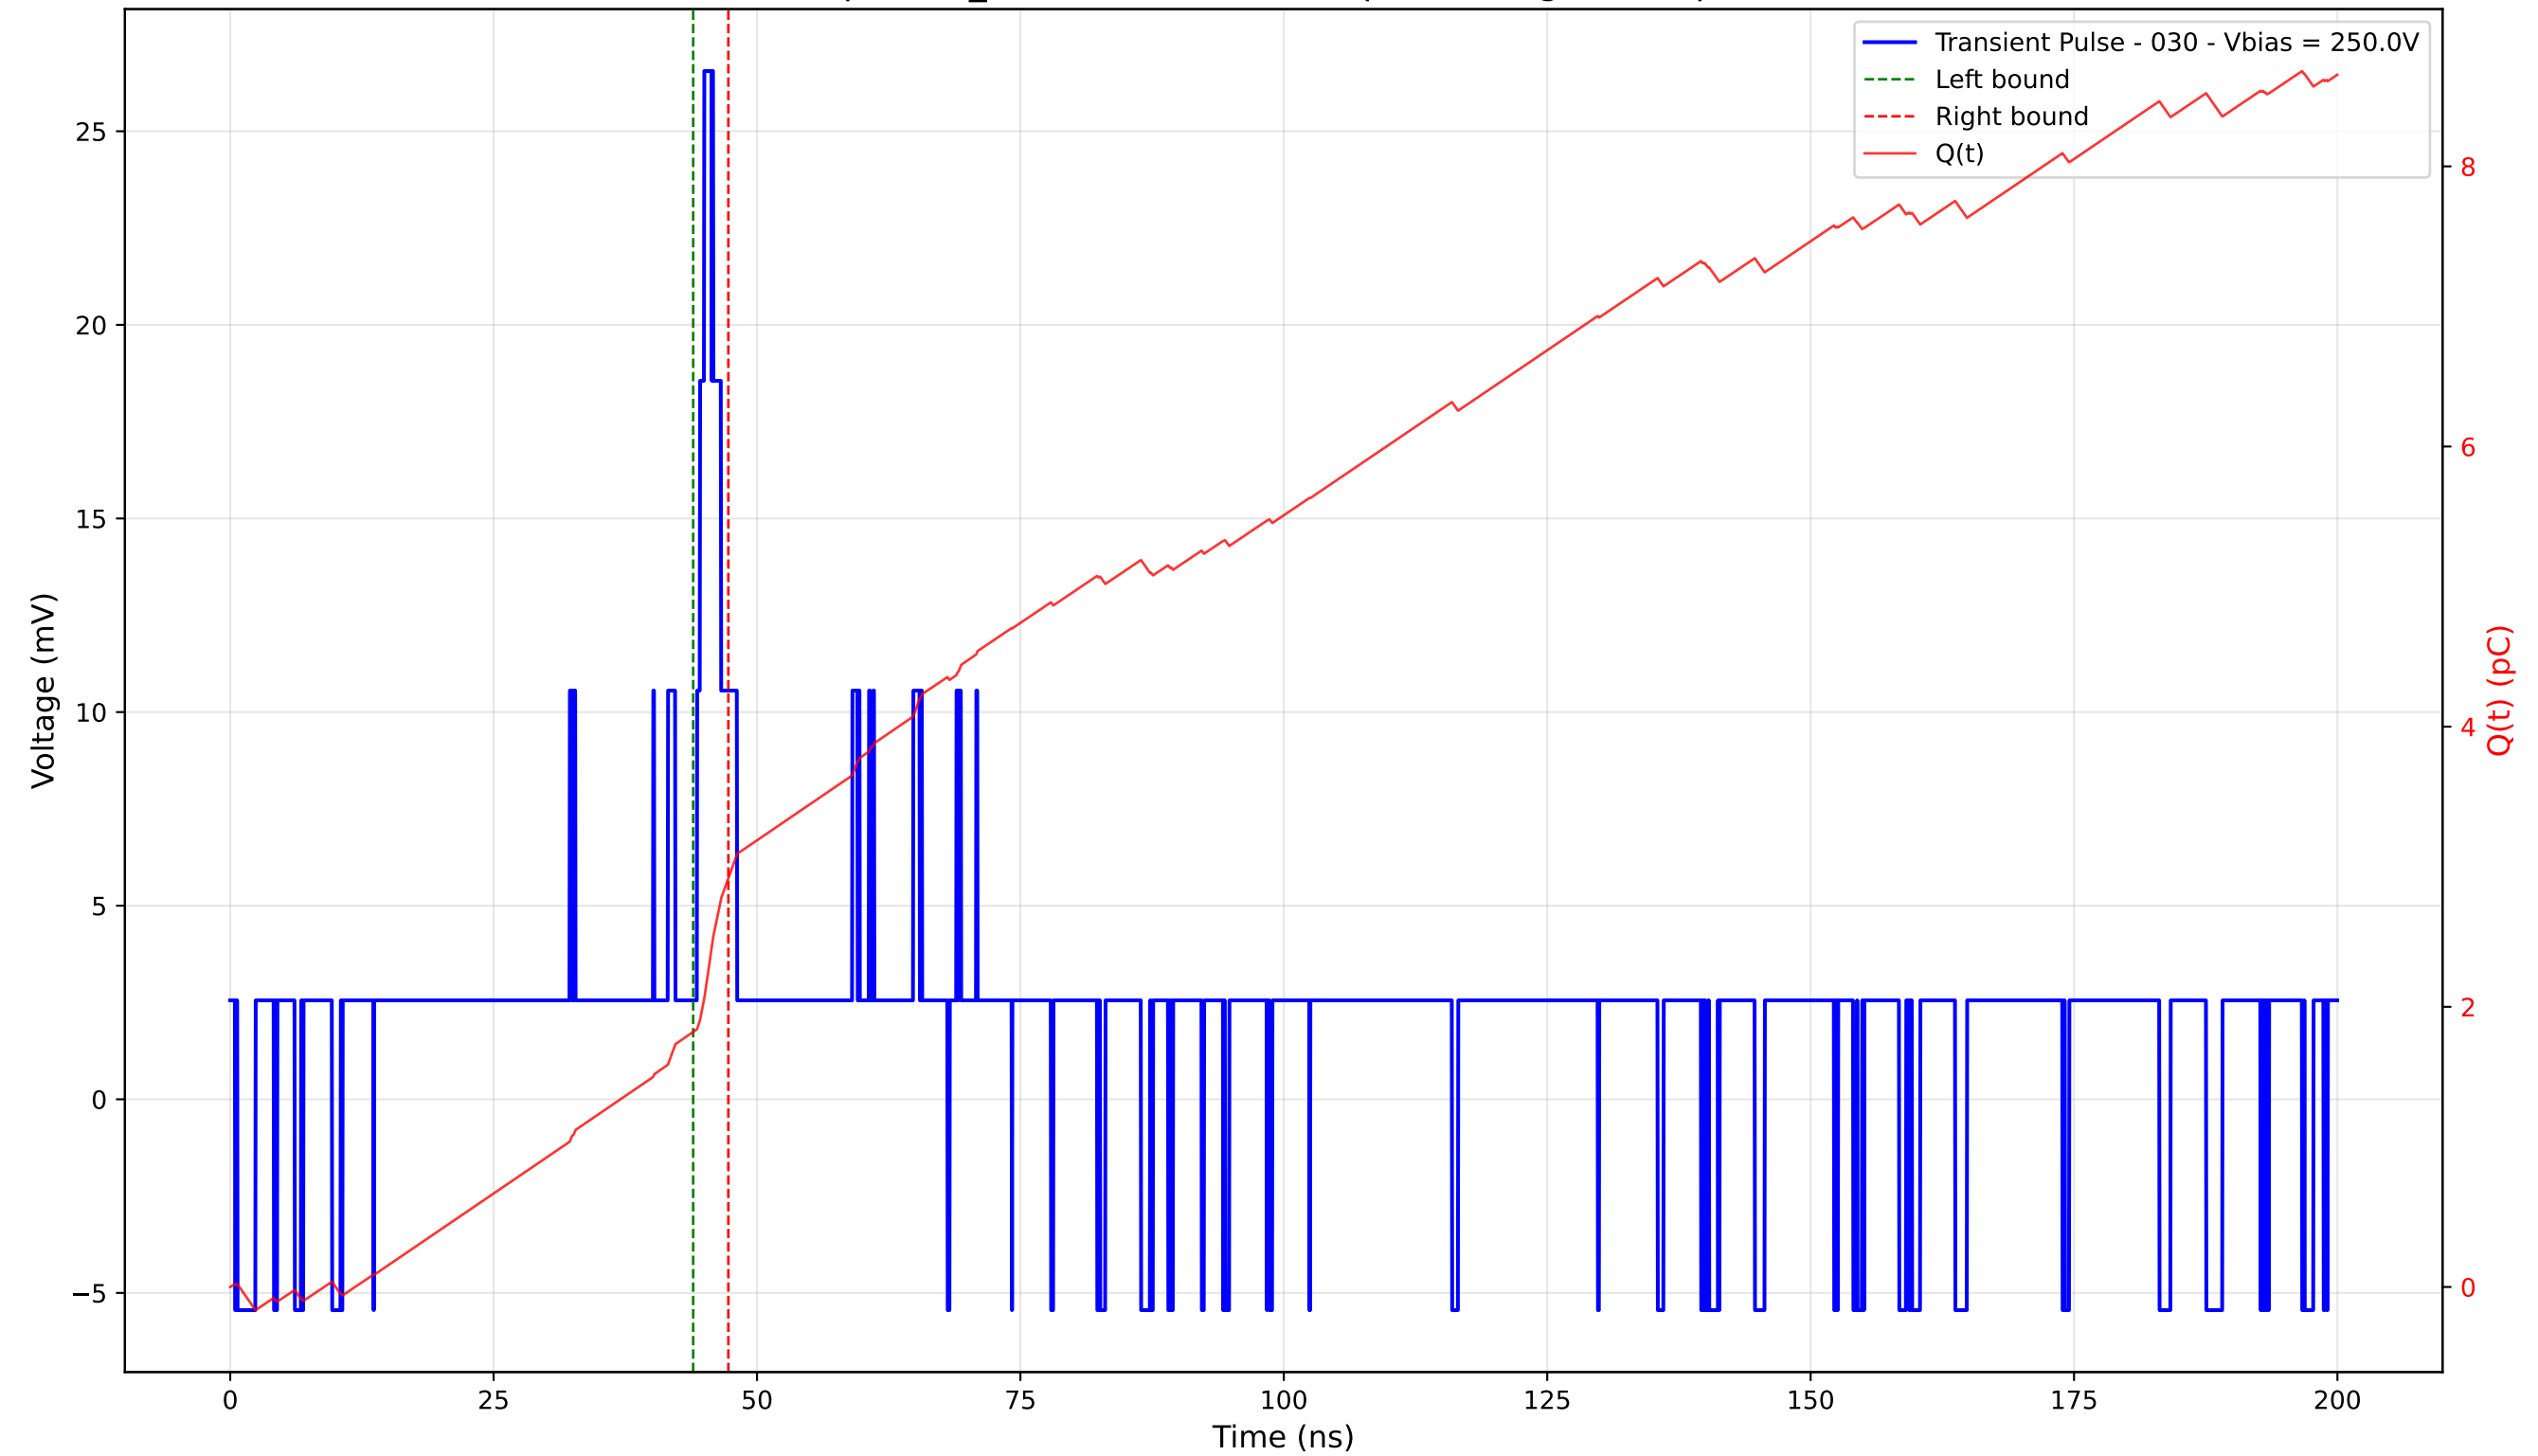


Transient Pulse - Sample: TD_4004 - Position: 30.0 μm - Charge: 1.04 pC - Rise Time: 0.58 ns

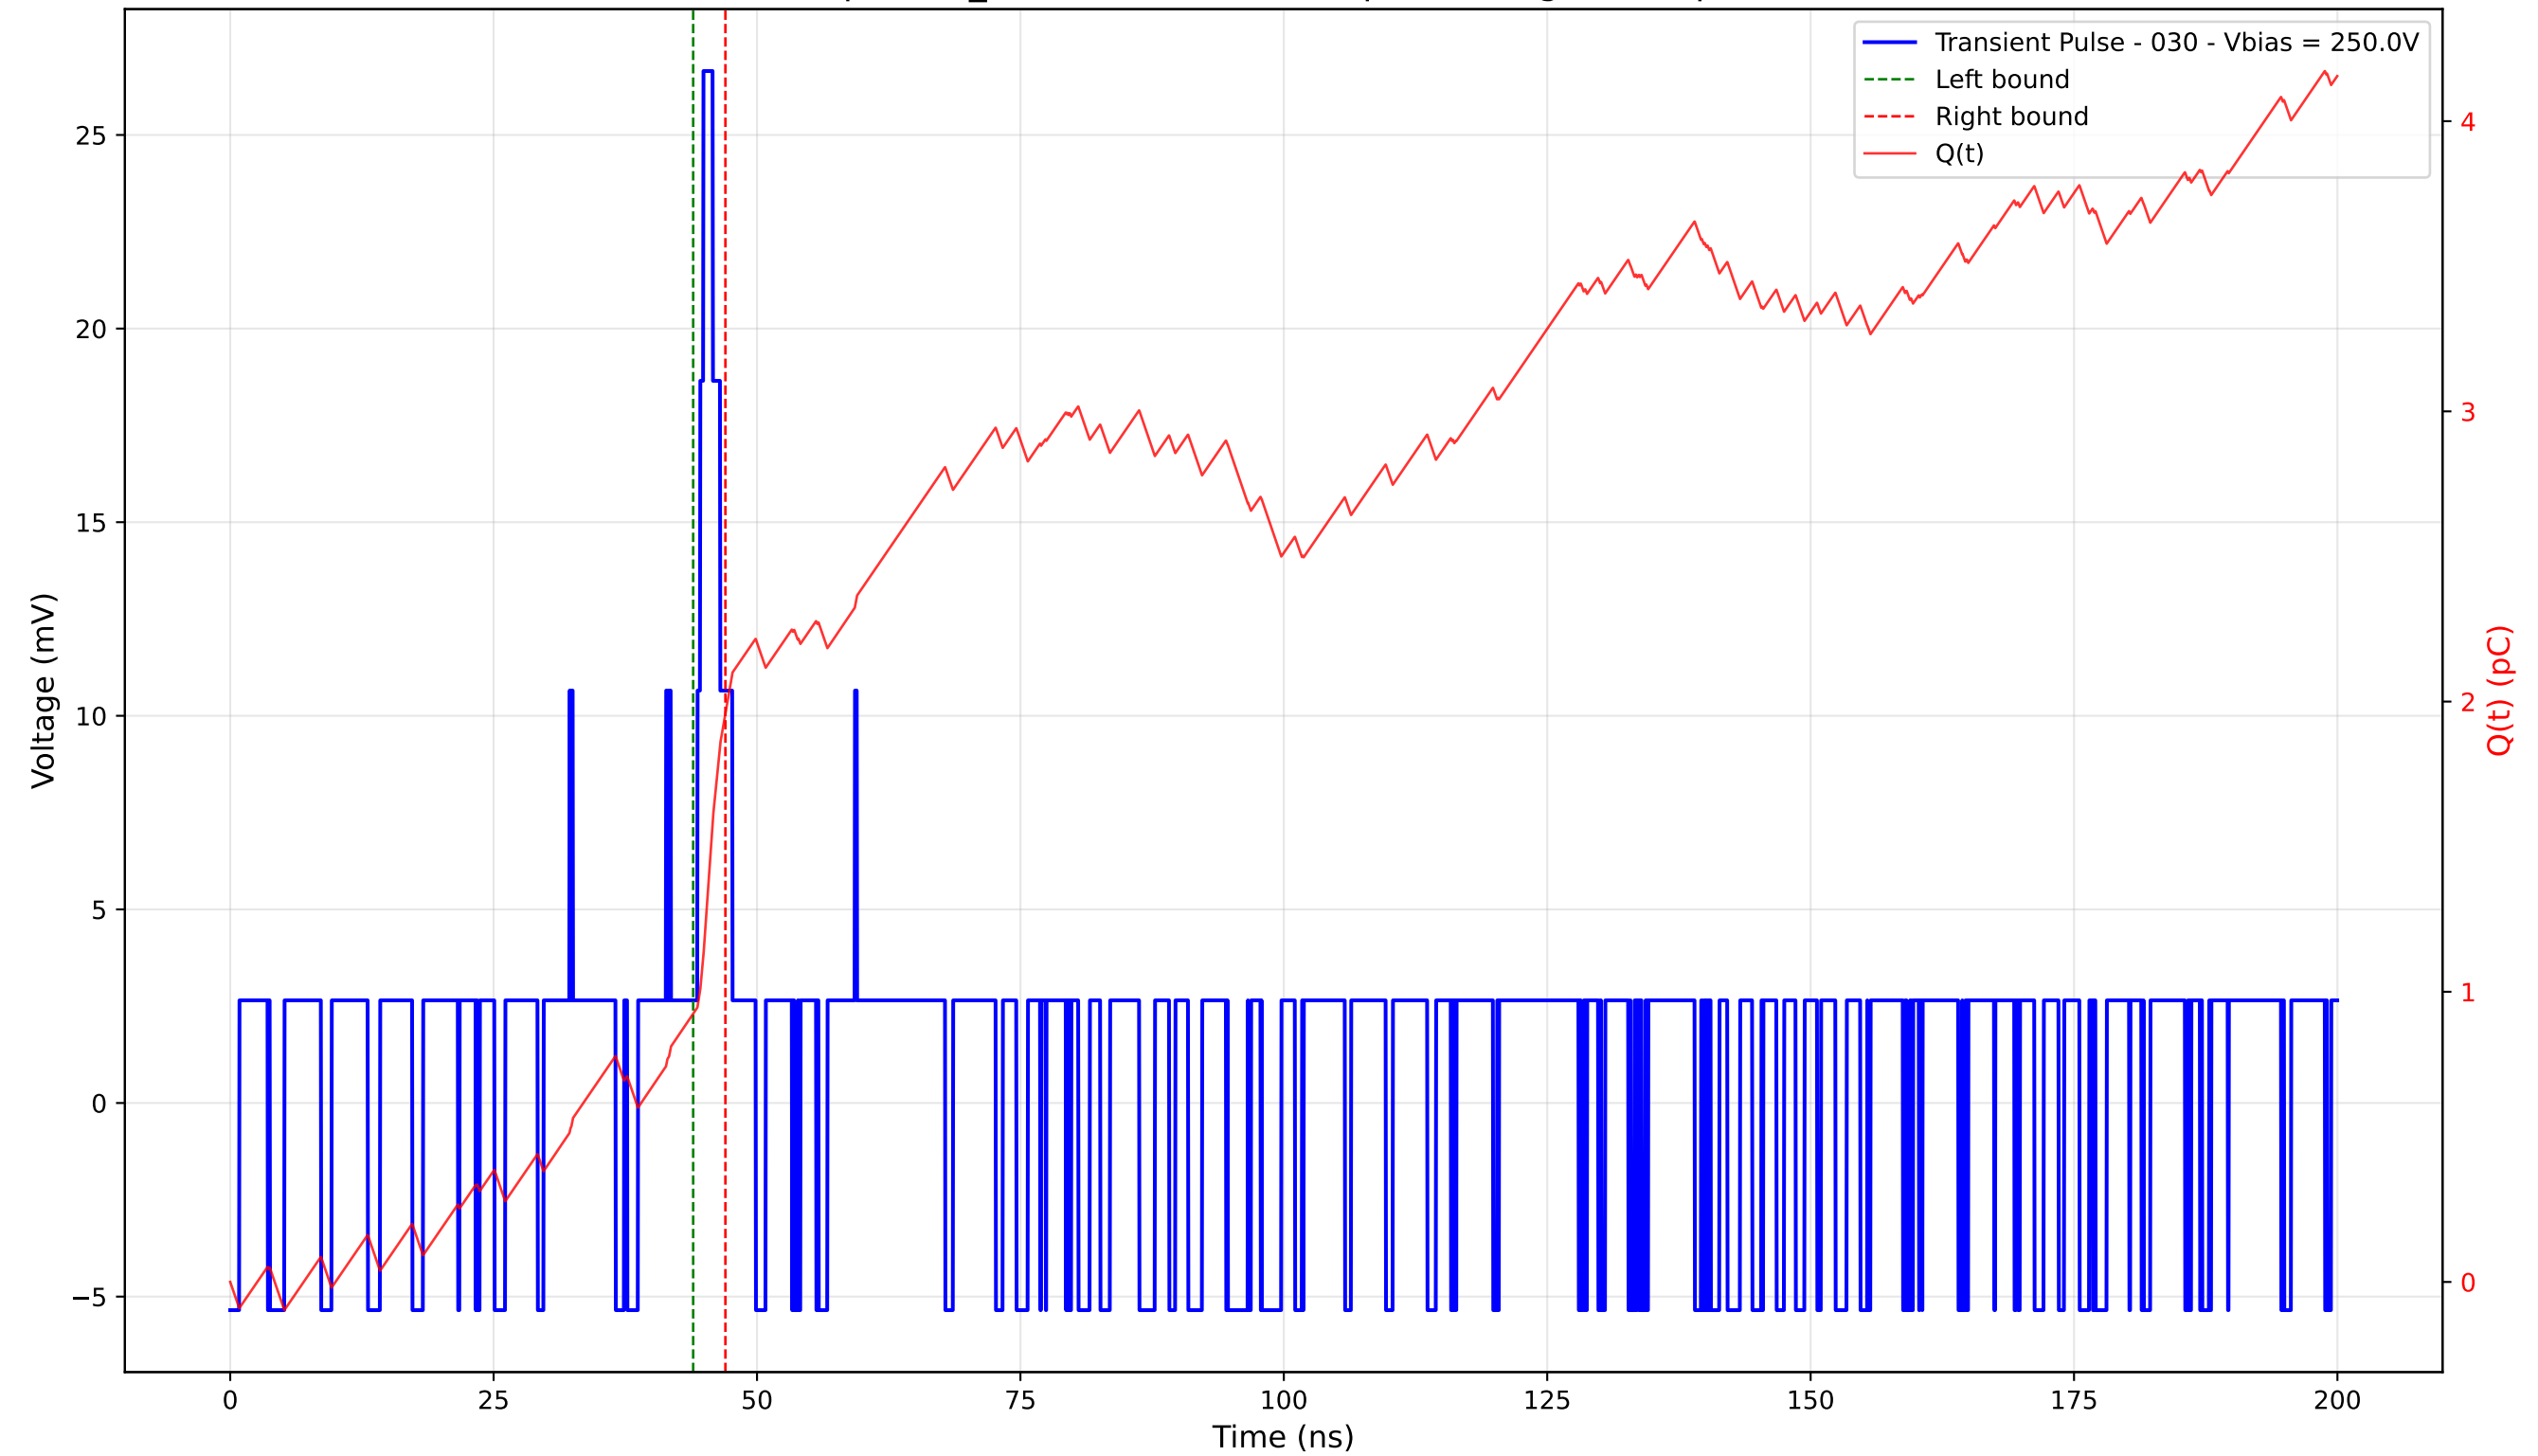


Transient Pulse - Sample: TD_4004 - Position: 35.0 μm - Charge: 1.47 pC - Rise Time: 0.80 ns

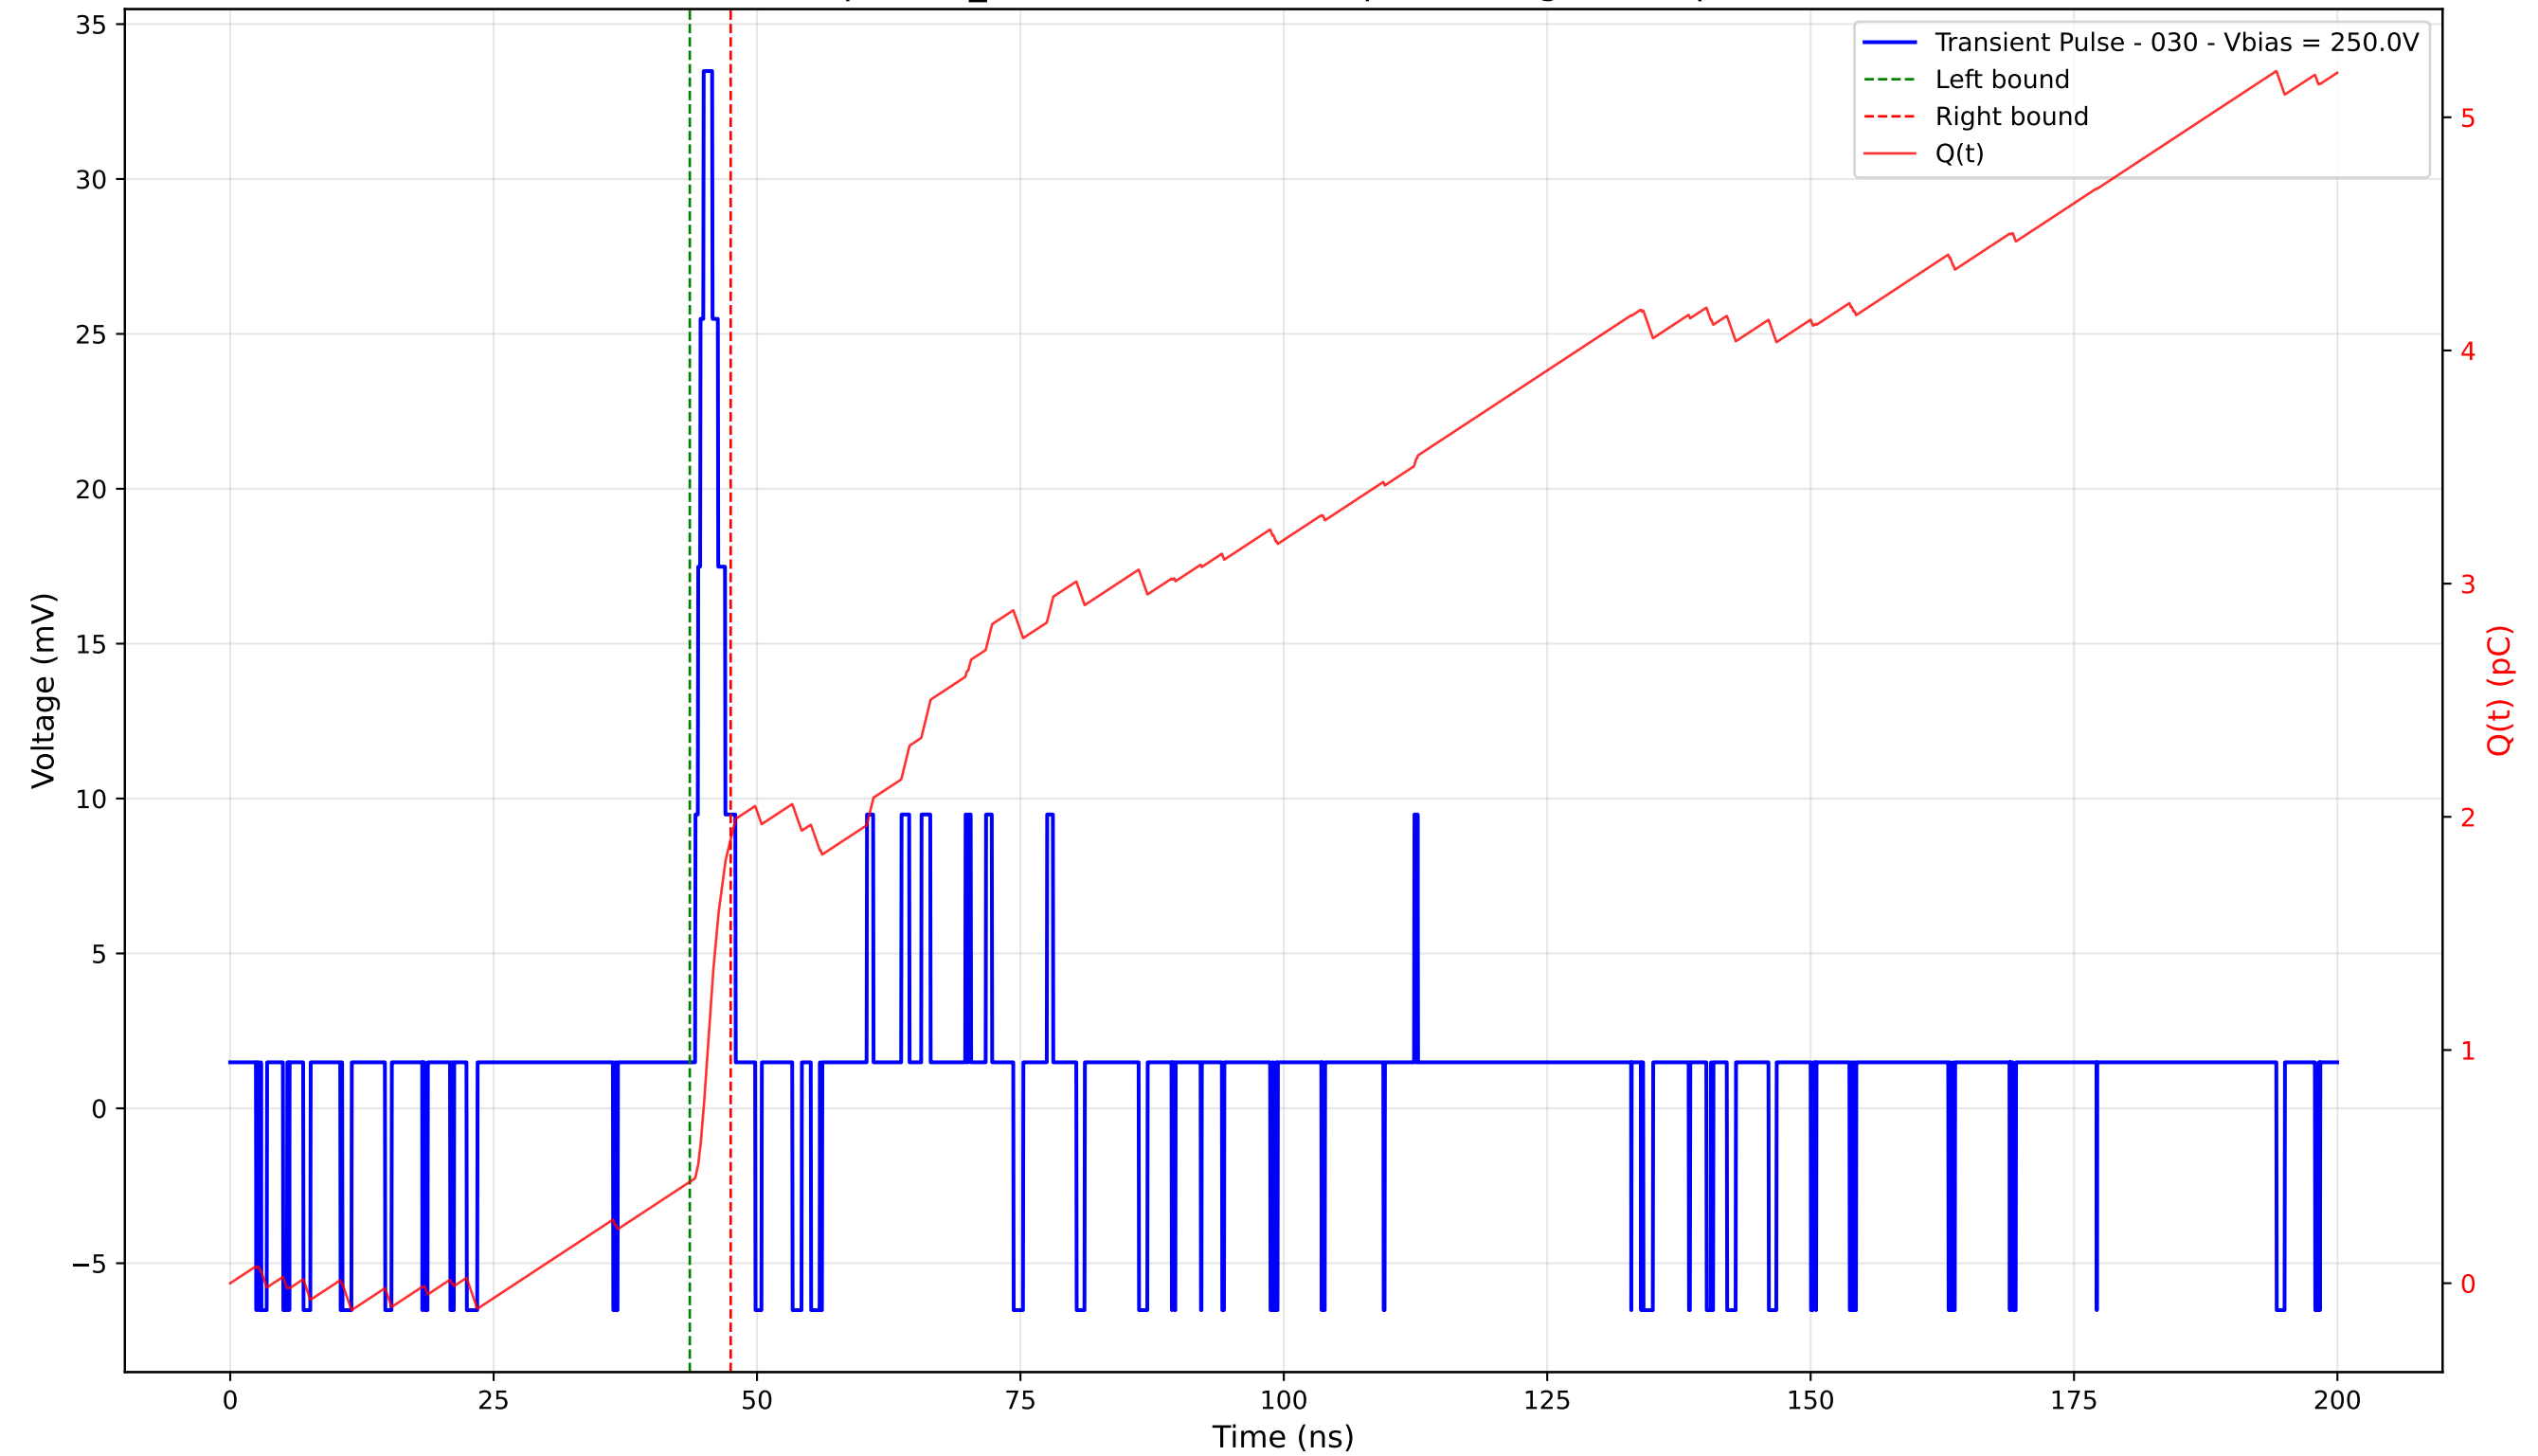


Transient Pulse - Sample: TD_4004 - Position: 40.0 μm - Charge: 1.85 pC - Rise Time: 0.79 ns

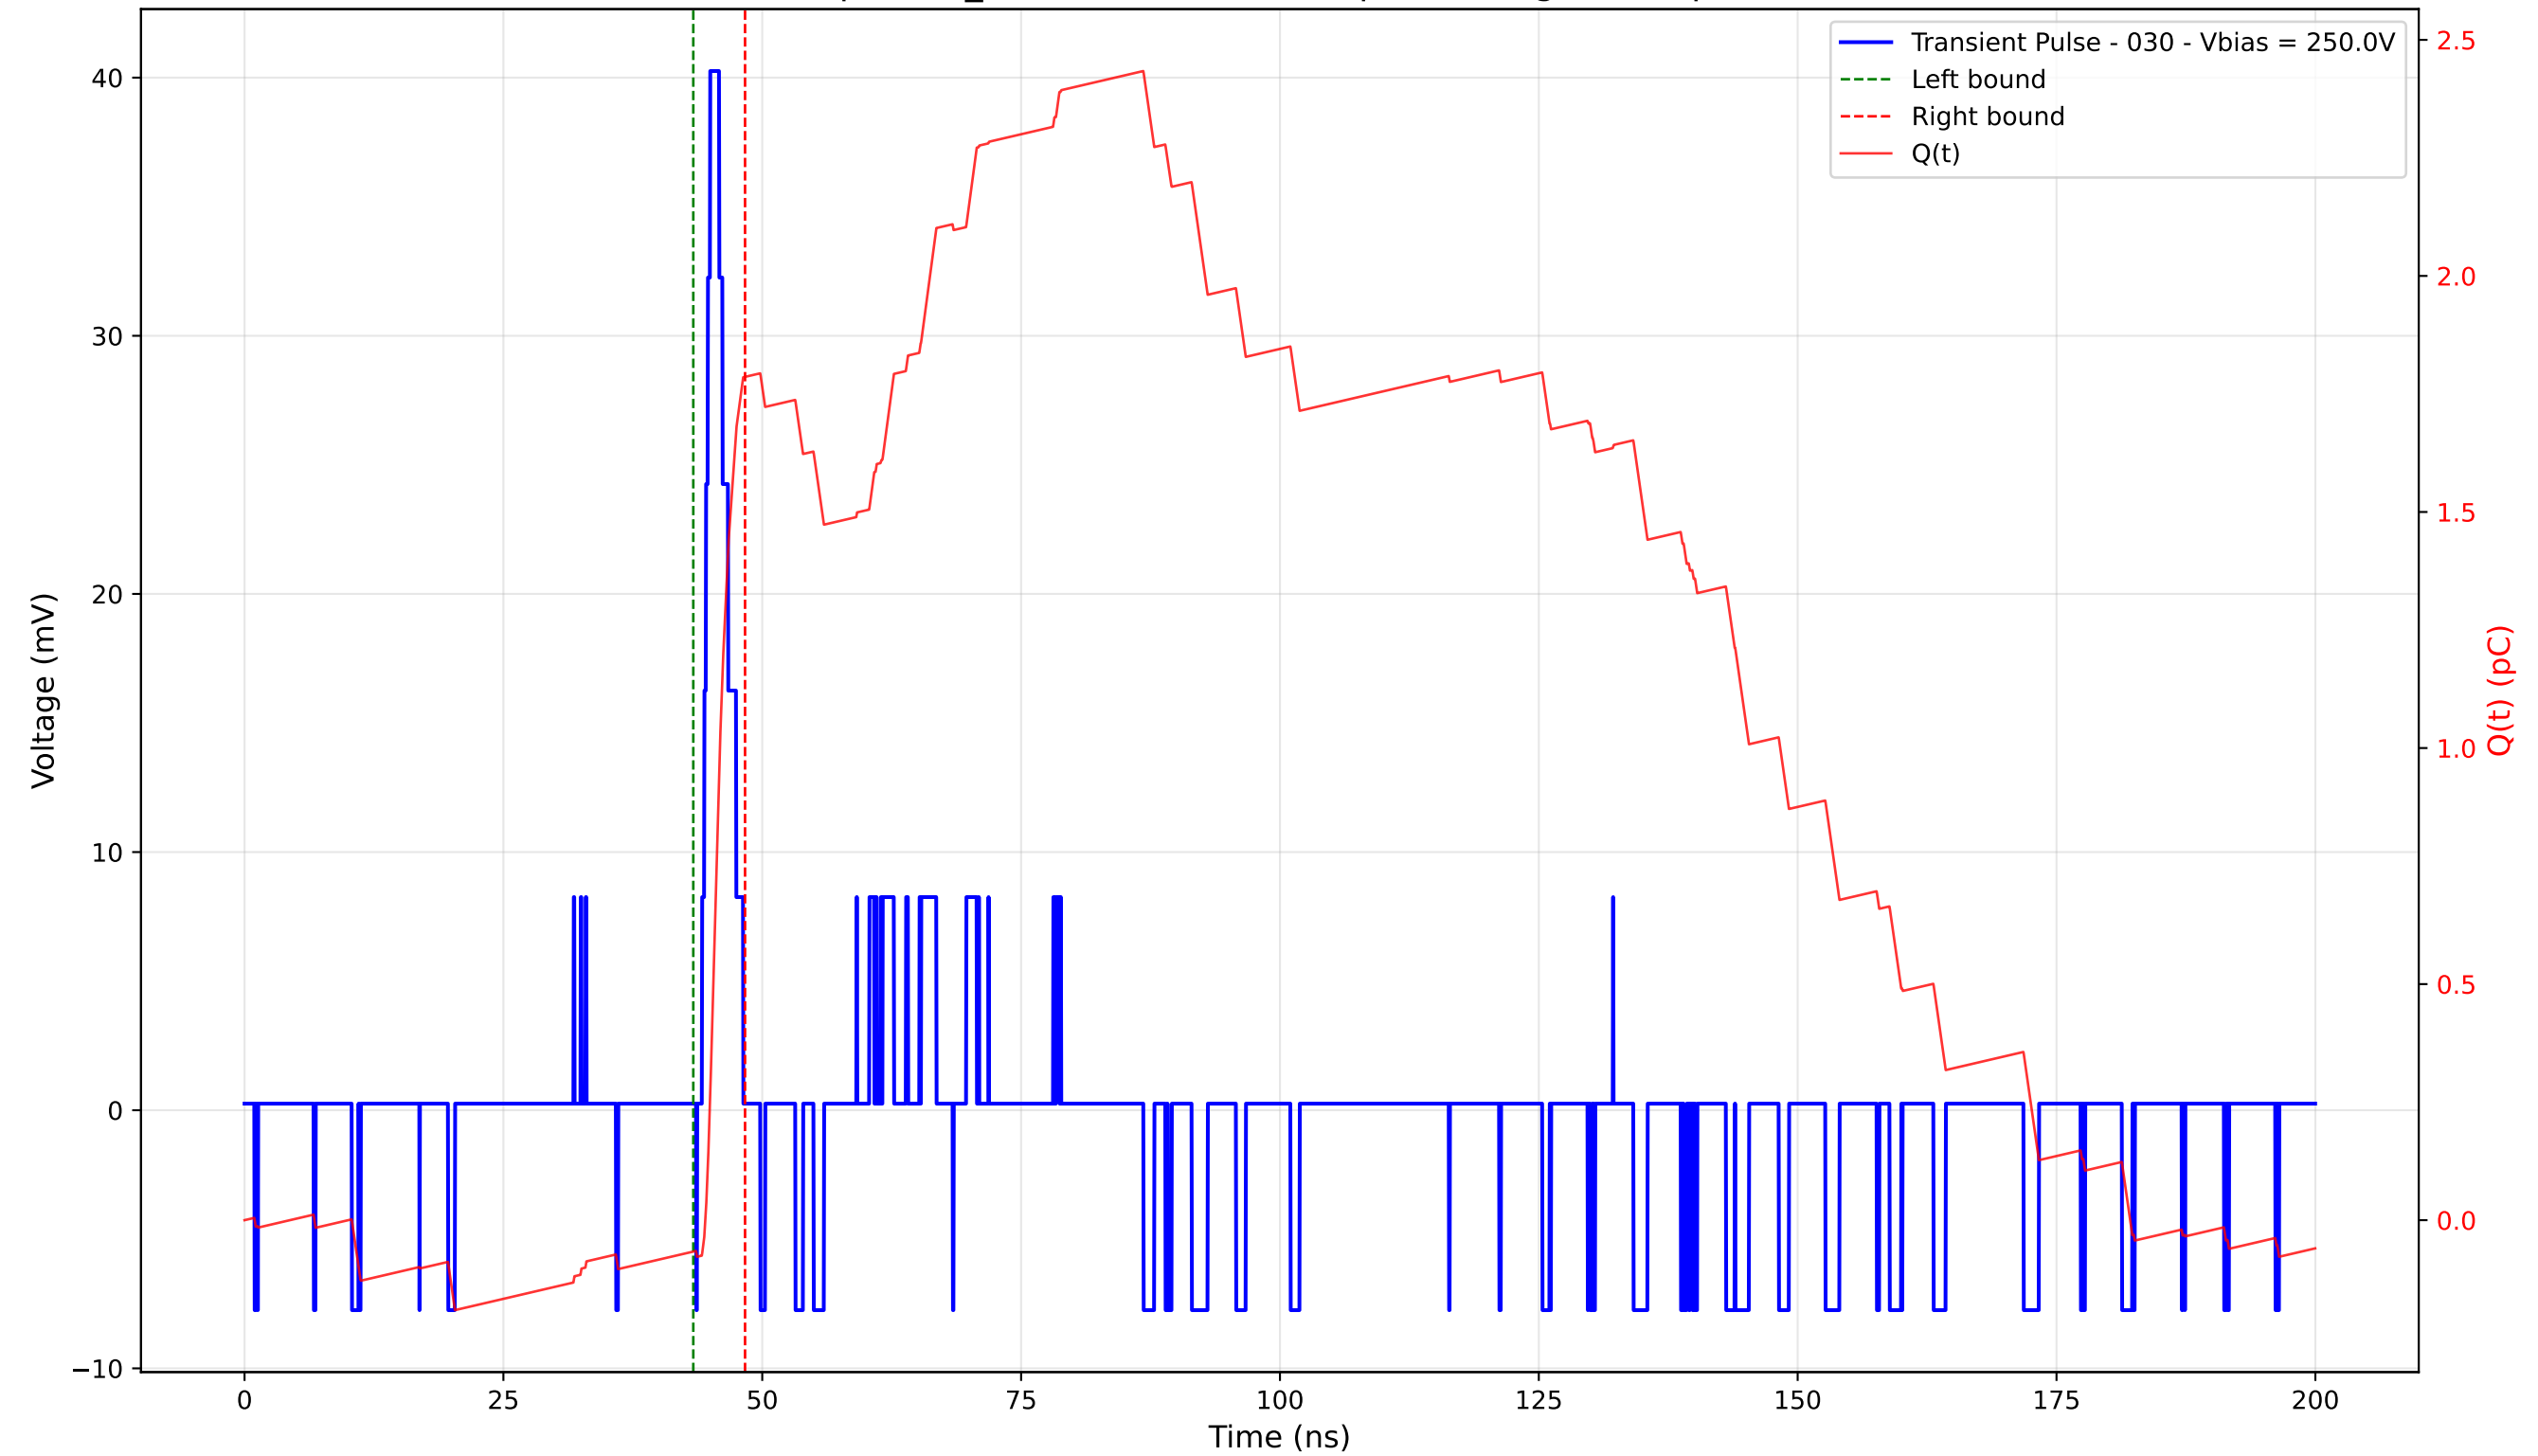


Transient Pulse - Sample: TD_4004 - Position: 45.0 μm - Charge: 3.25 pC - Rise Time: 1.21 ns

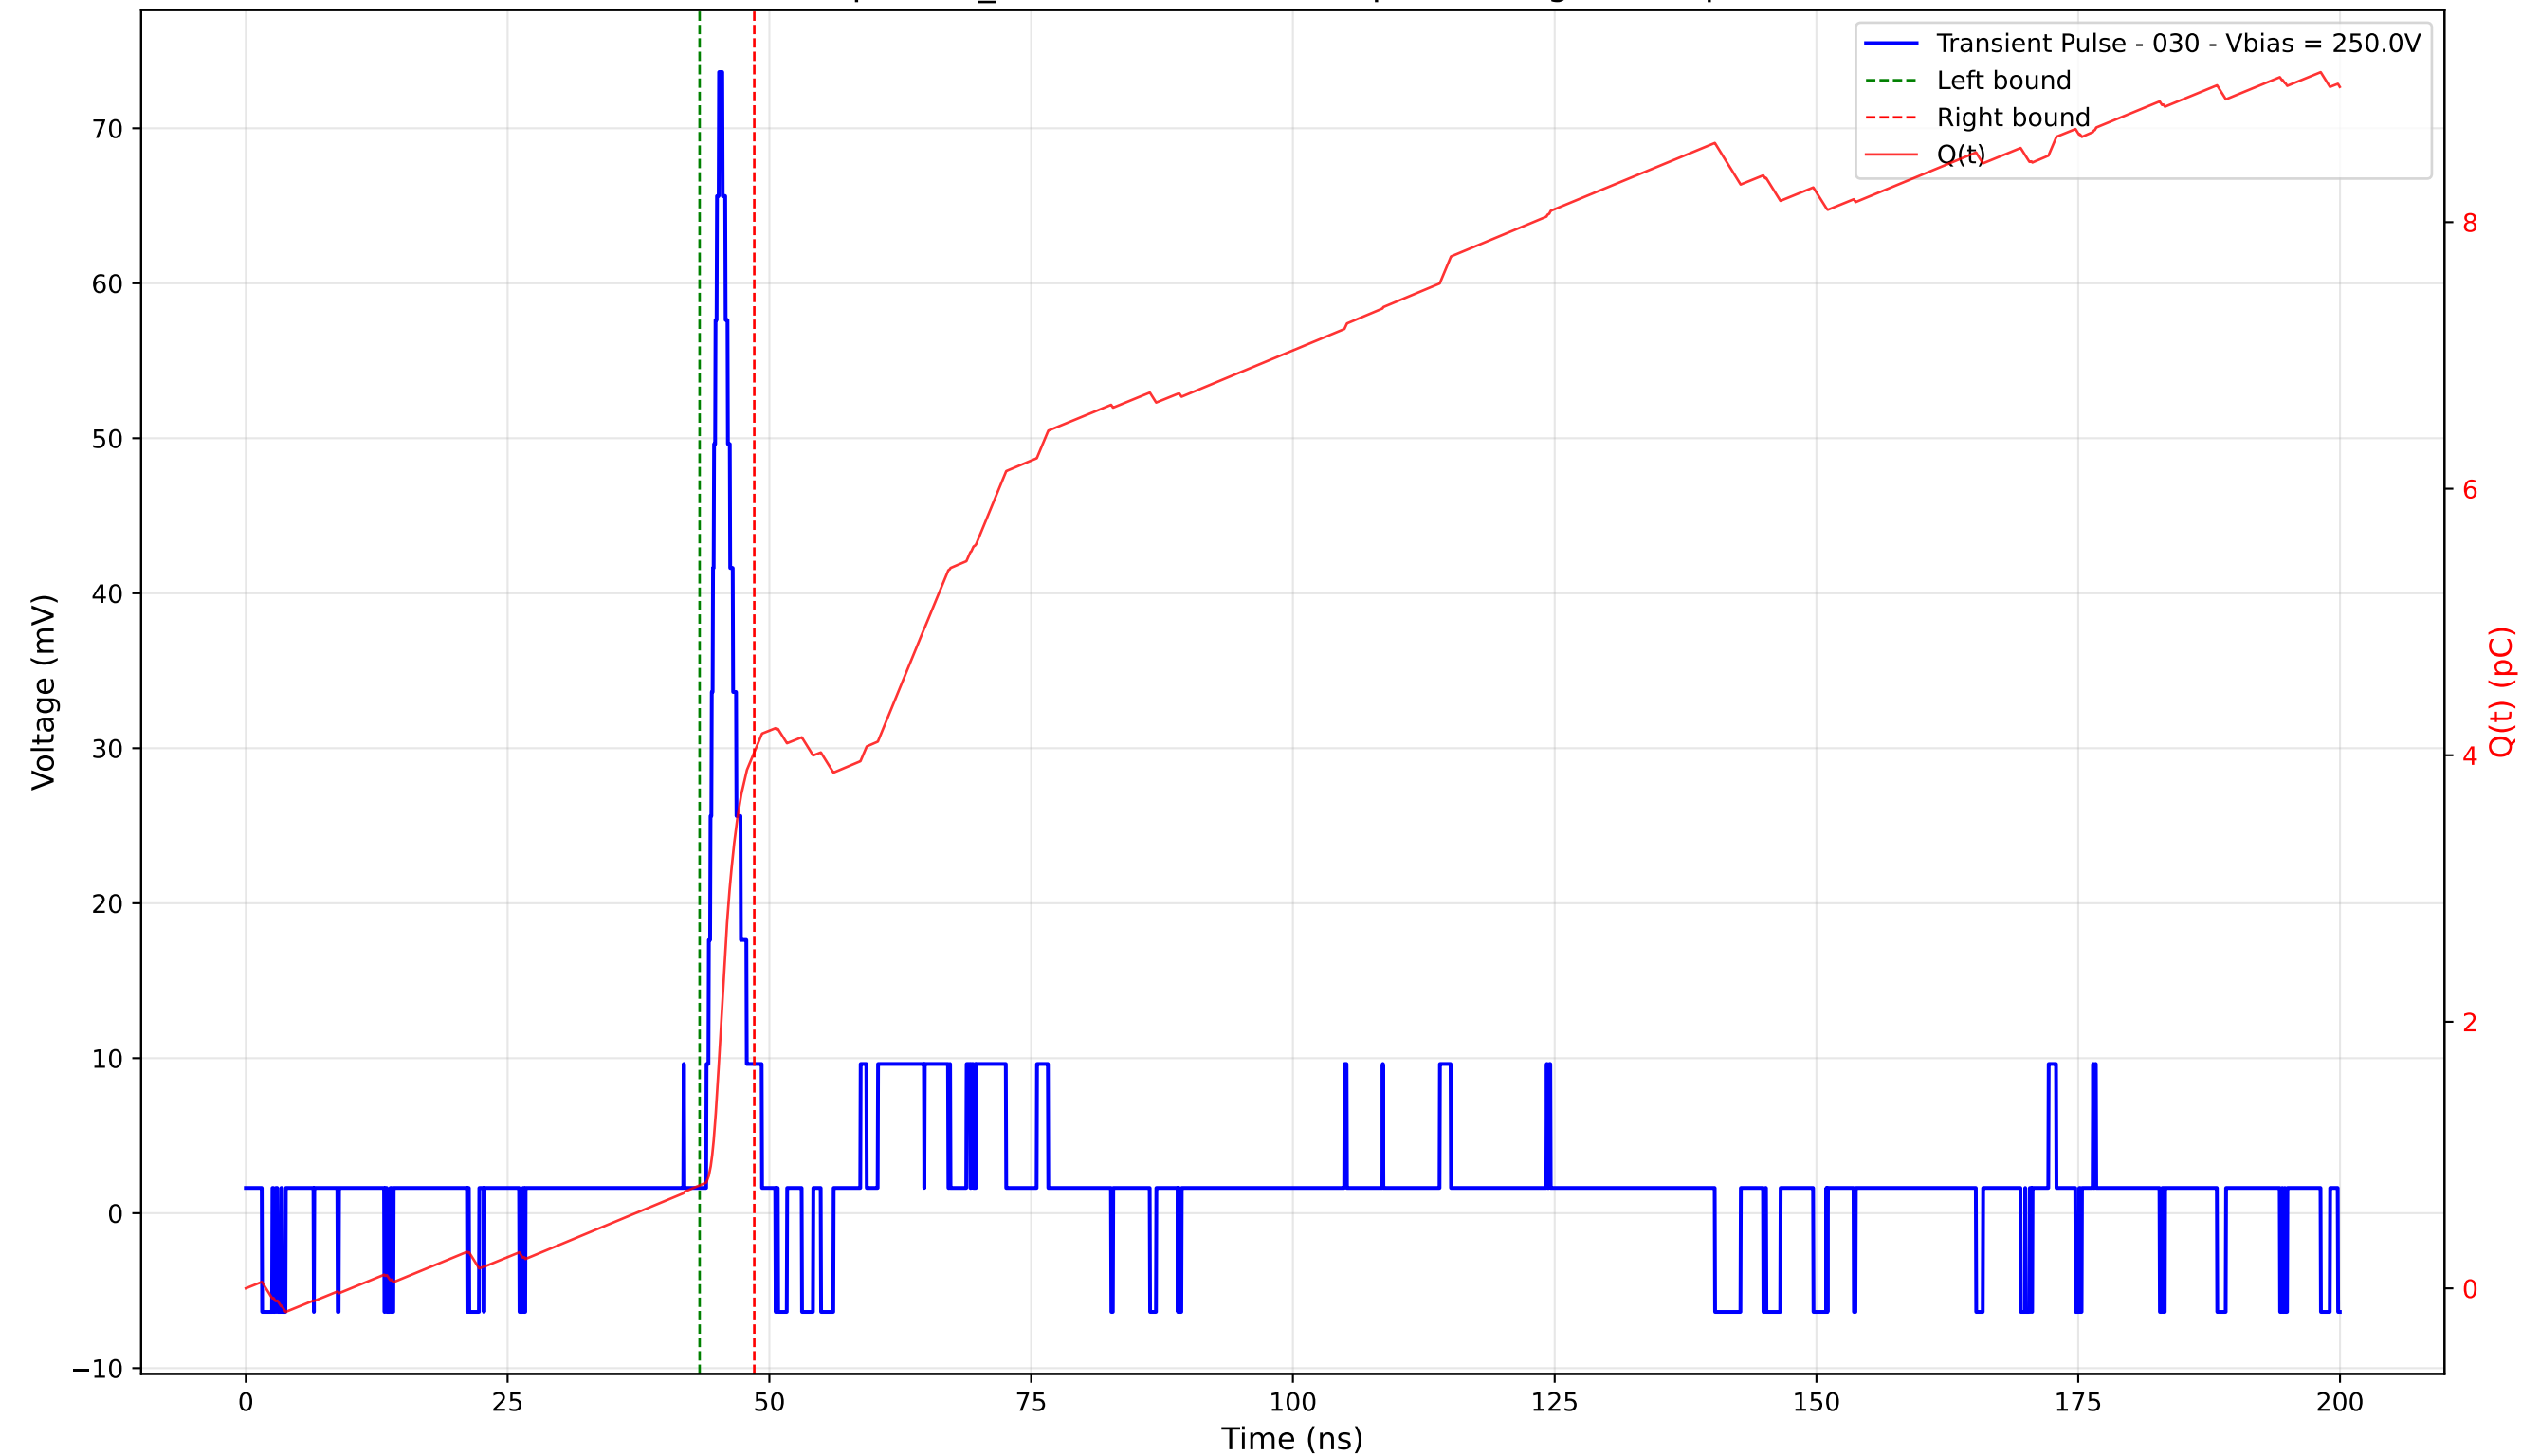


Transient Pulse - Sample: TD_4004 - Position: 50.0 μm - Charge: 5.26 pC - Rise Time: 0.96 ns

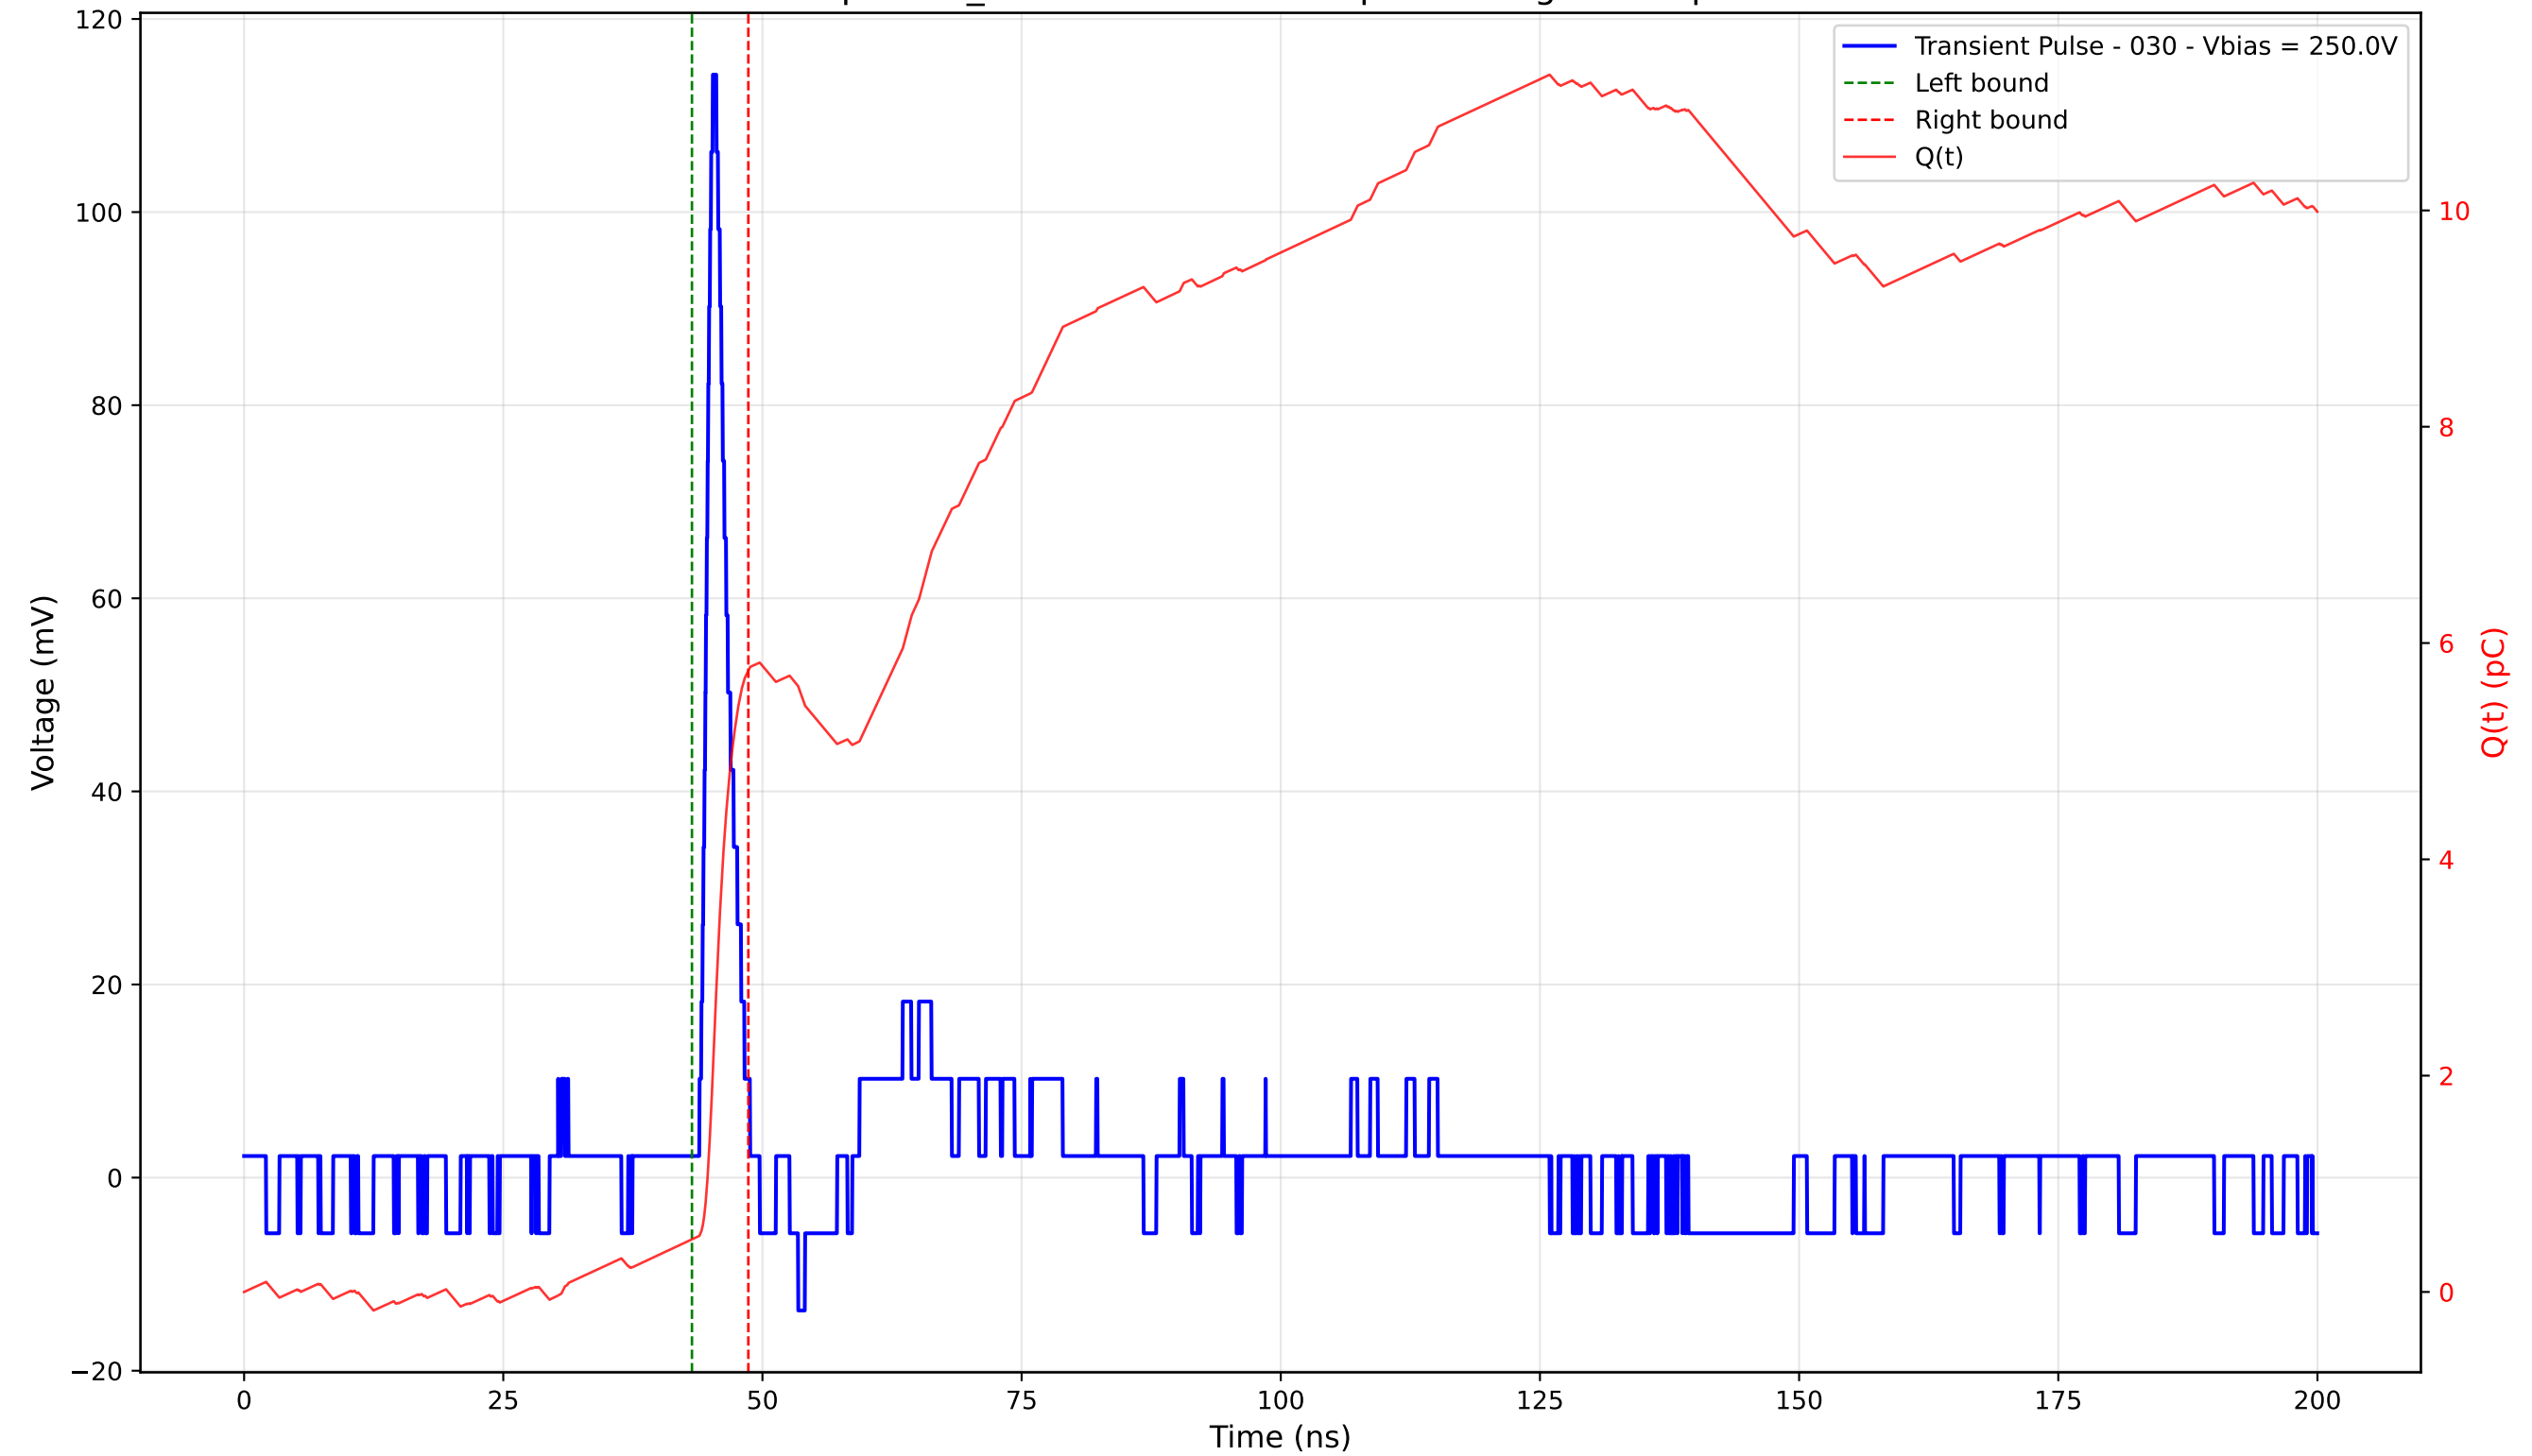


Transient Pulse - Sample: TD_4004 - Position: 55.0 μm - Charge: 8.00 pC - Rise Time: 0.84 ns

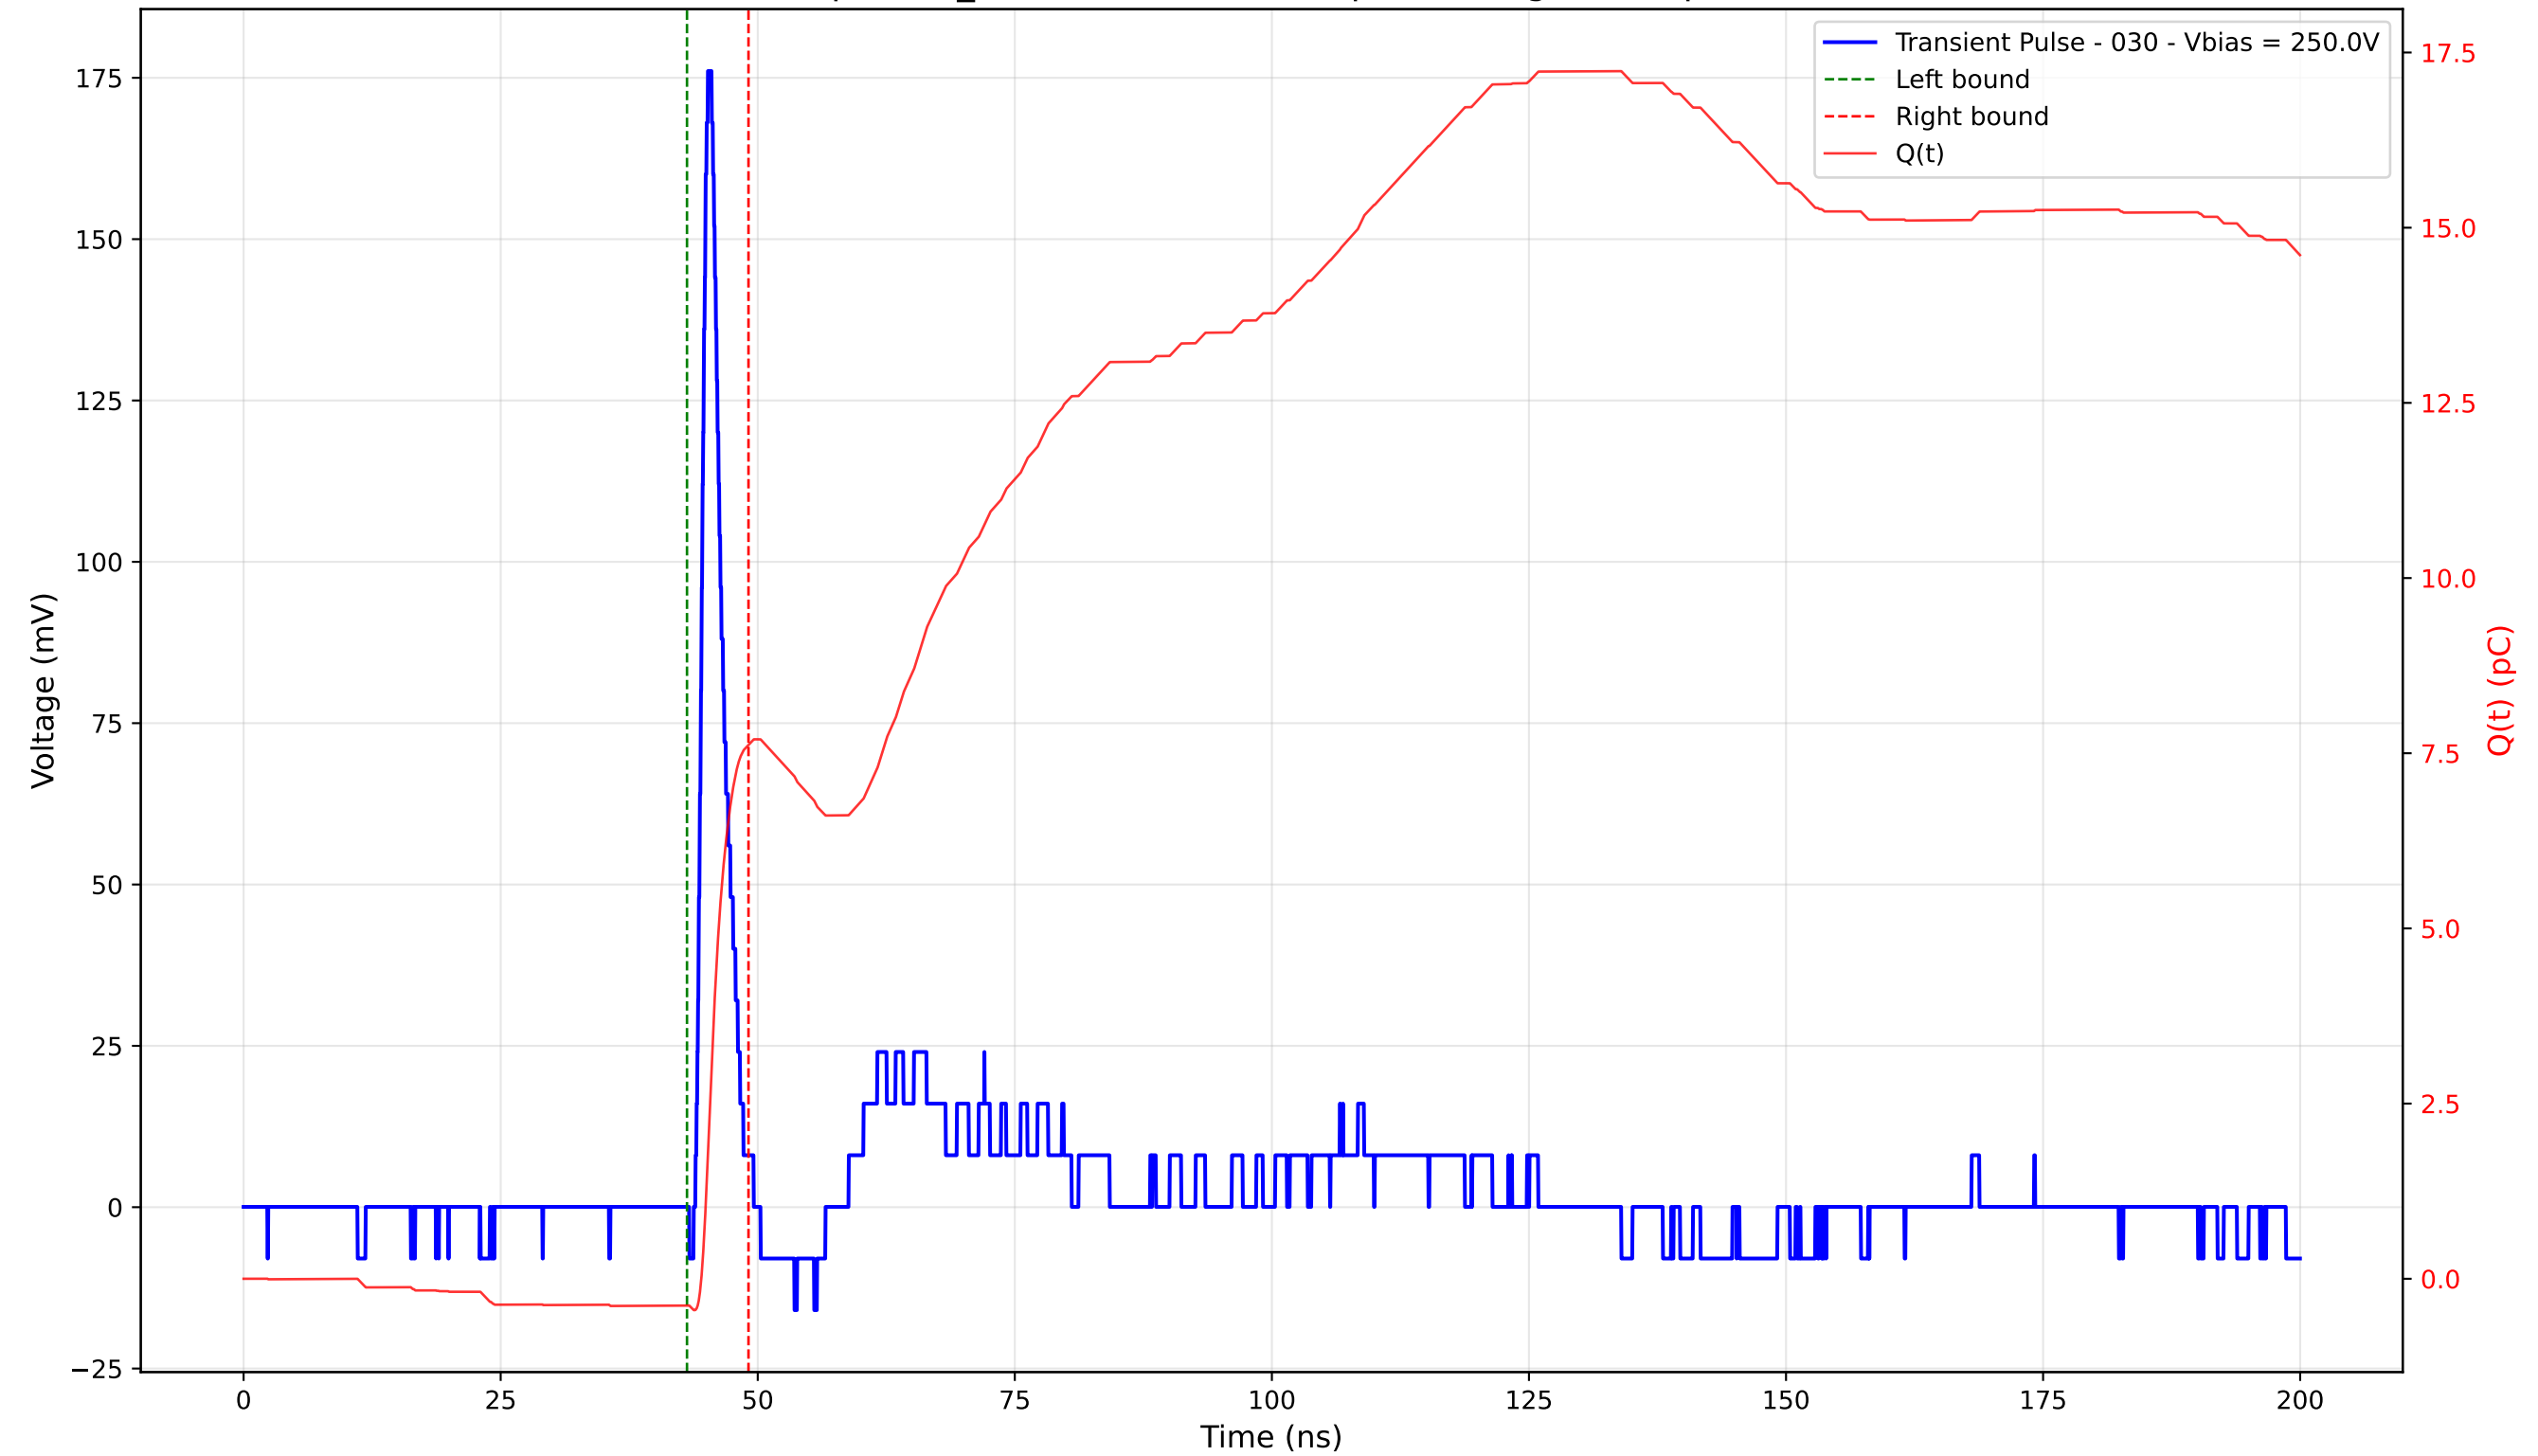


Transient Pulse - Sample: TD_4004 - Position: 60.0 μm - Charge: 12.38 pC - Rise Time: 0.90 ns

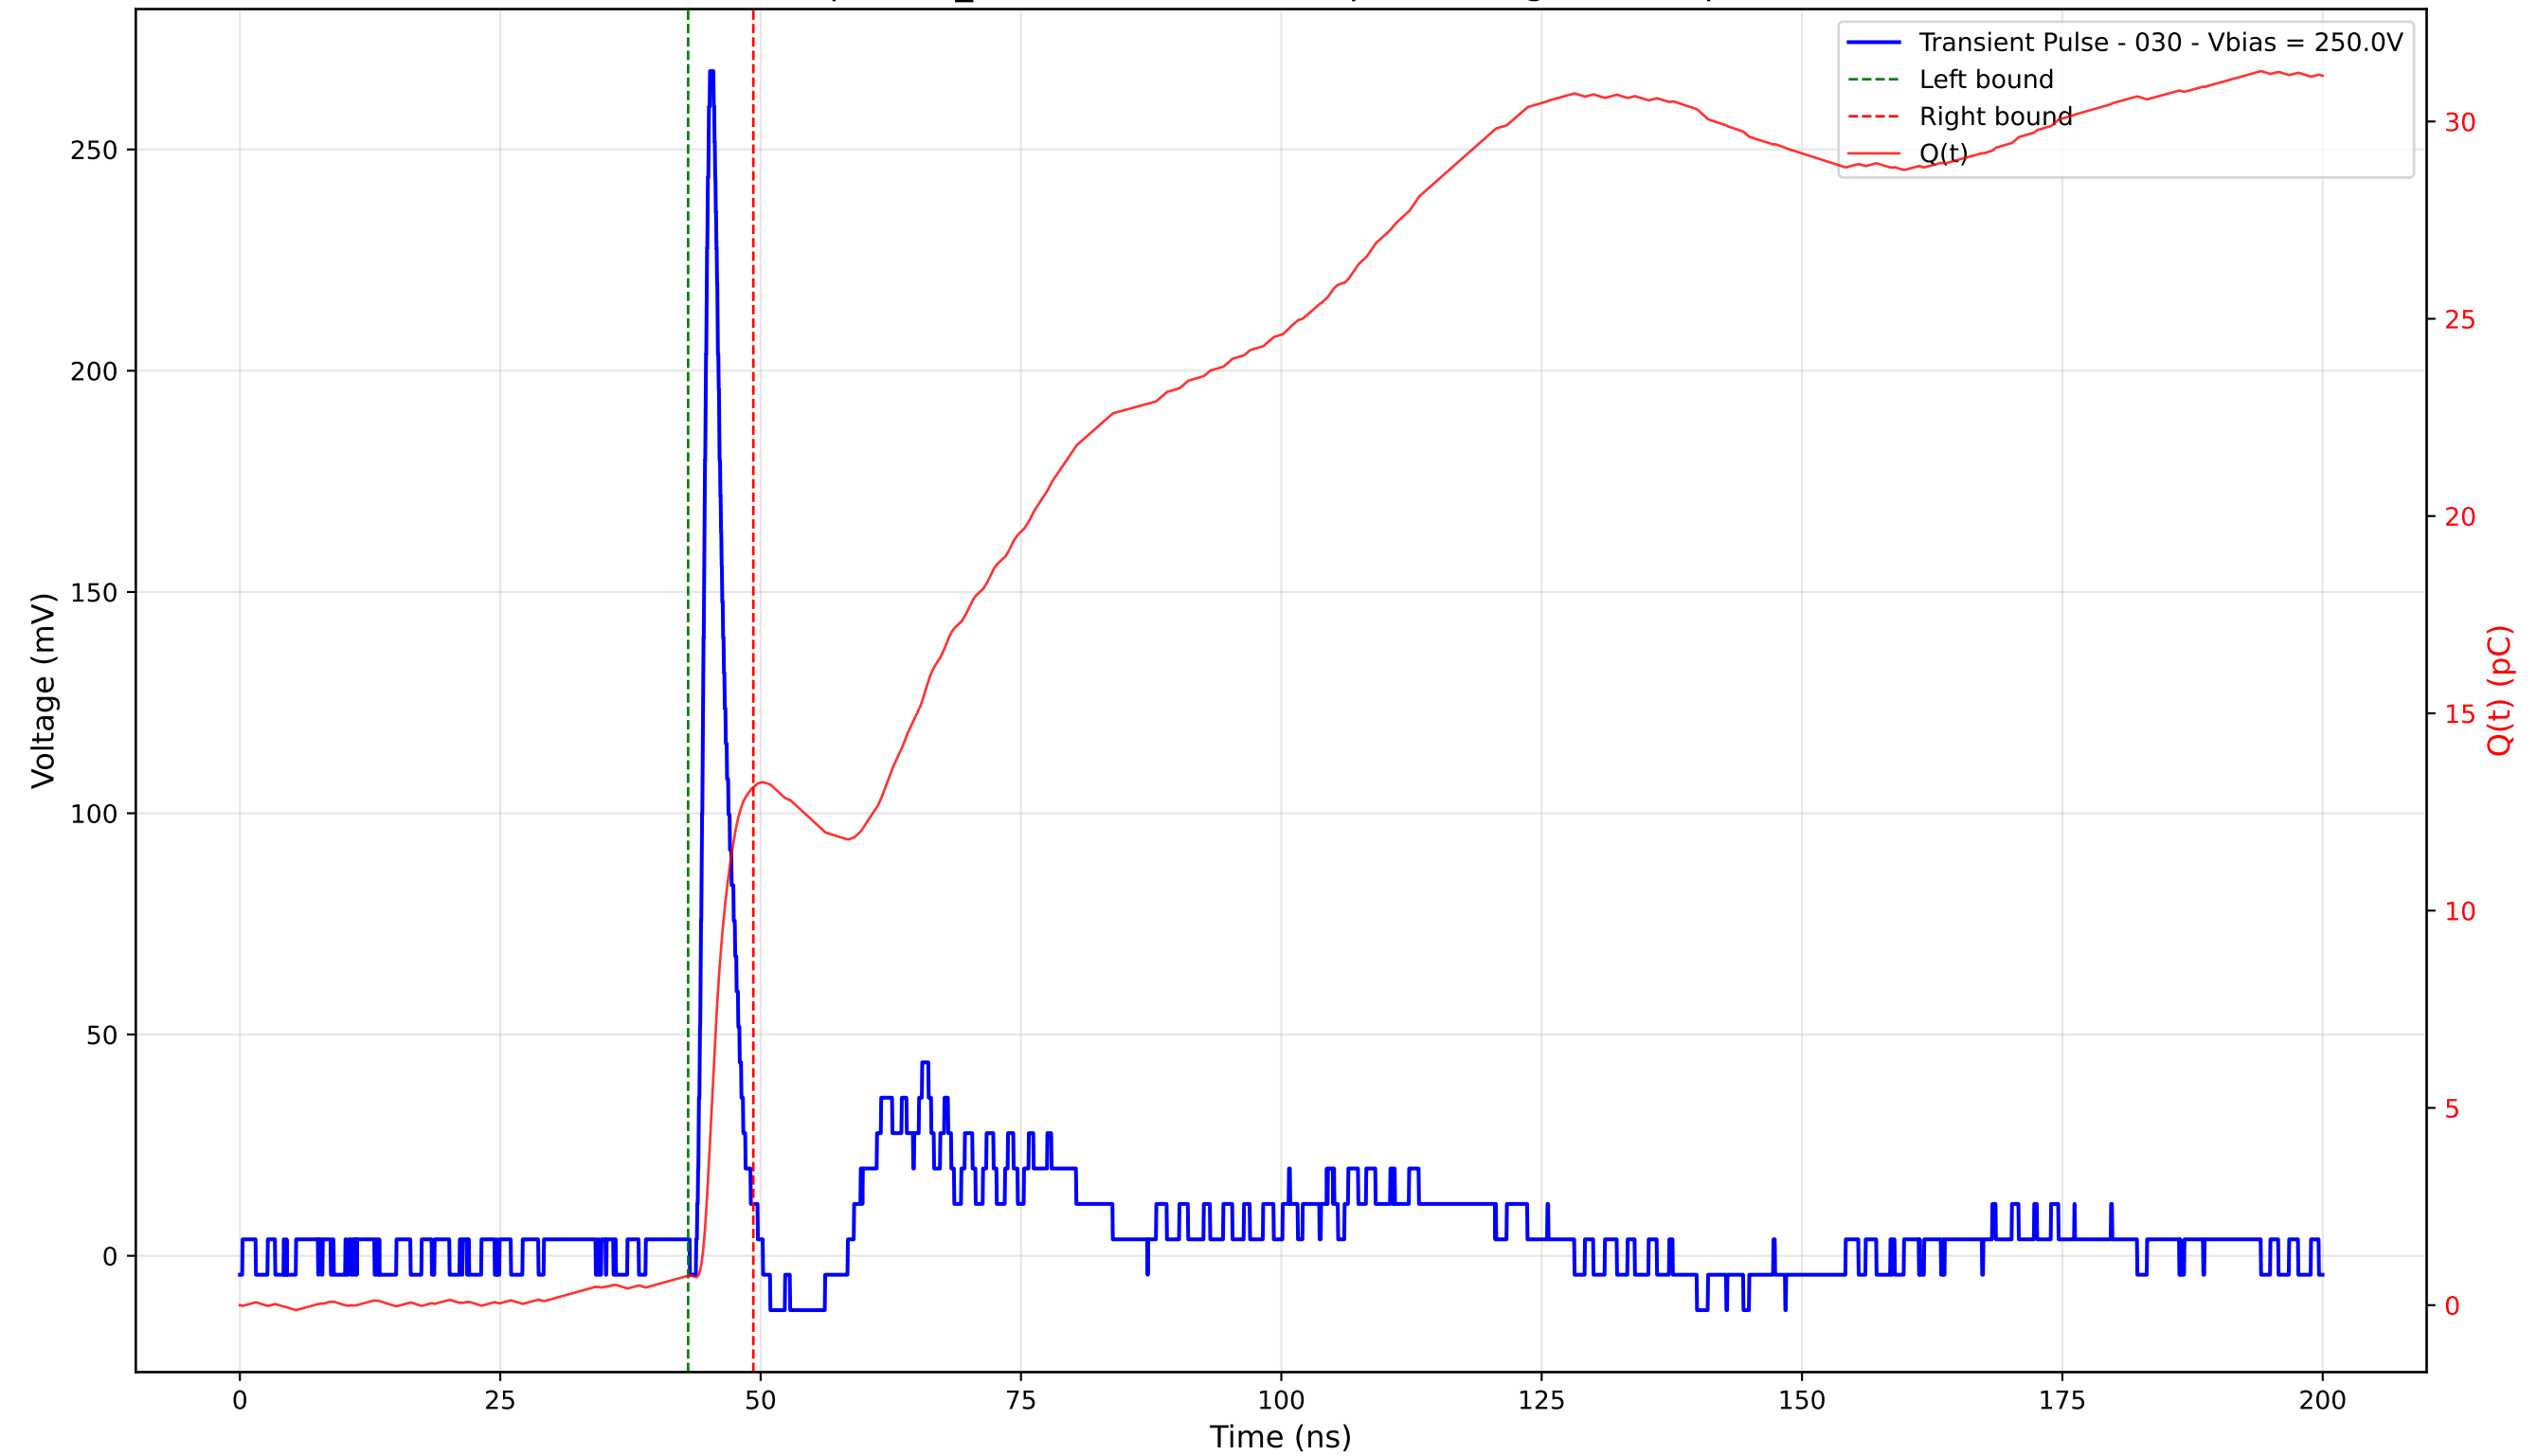


Transient Pulse - Sample: TD_4004 - Position: 65.0 μm - Charge: 17.81 pC - Rise Time: 0.93 ns

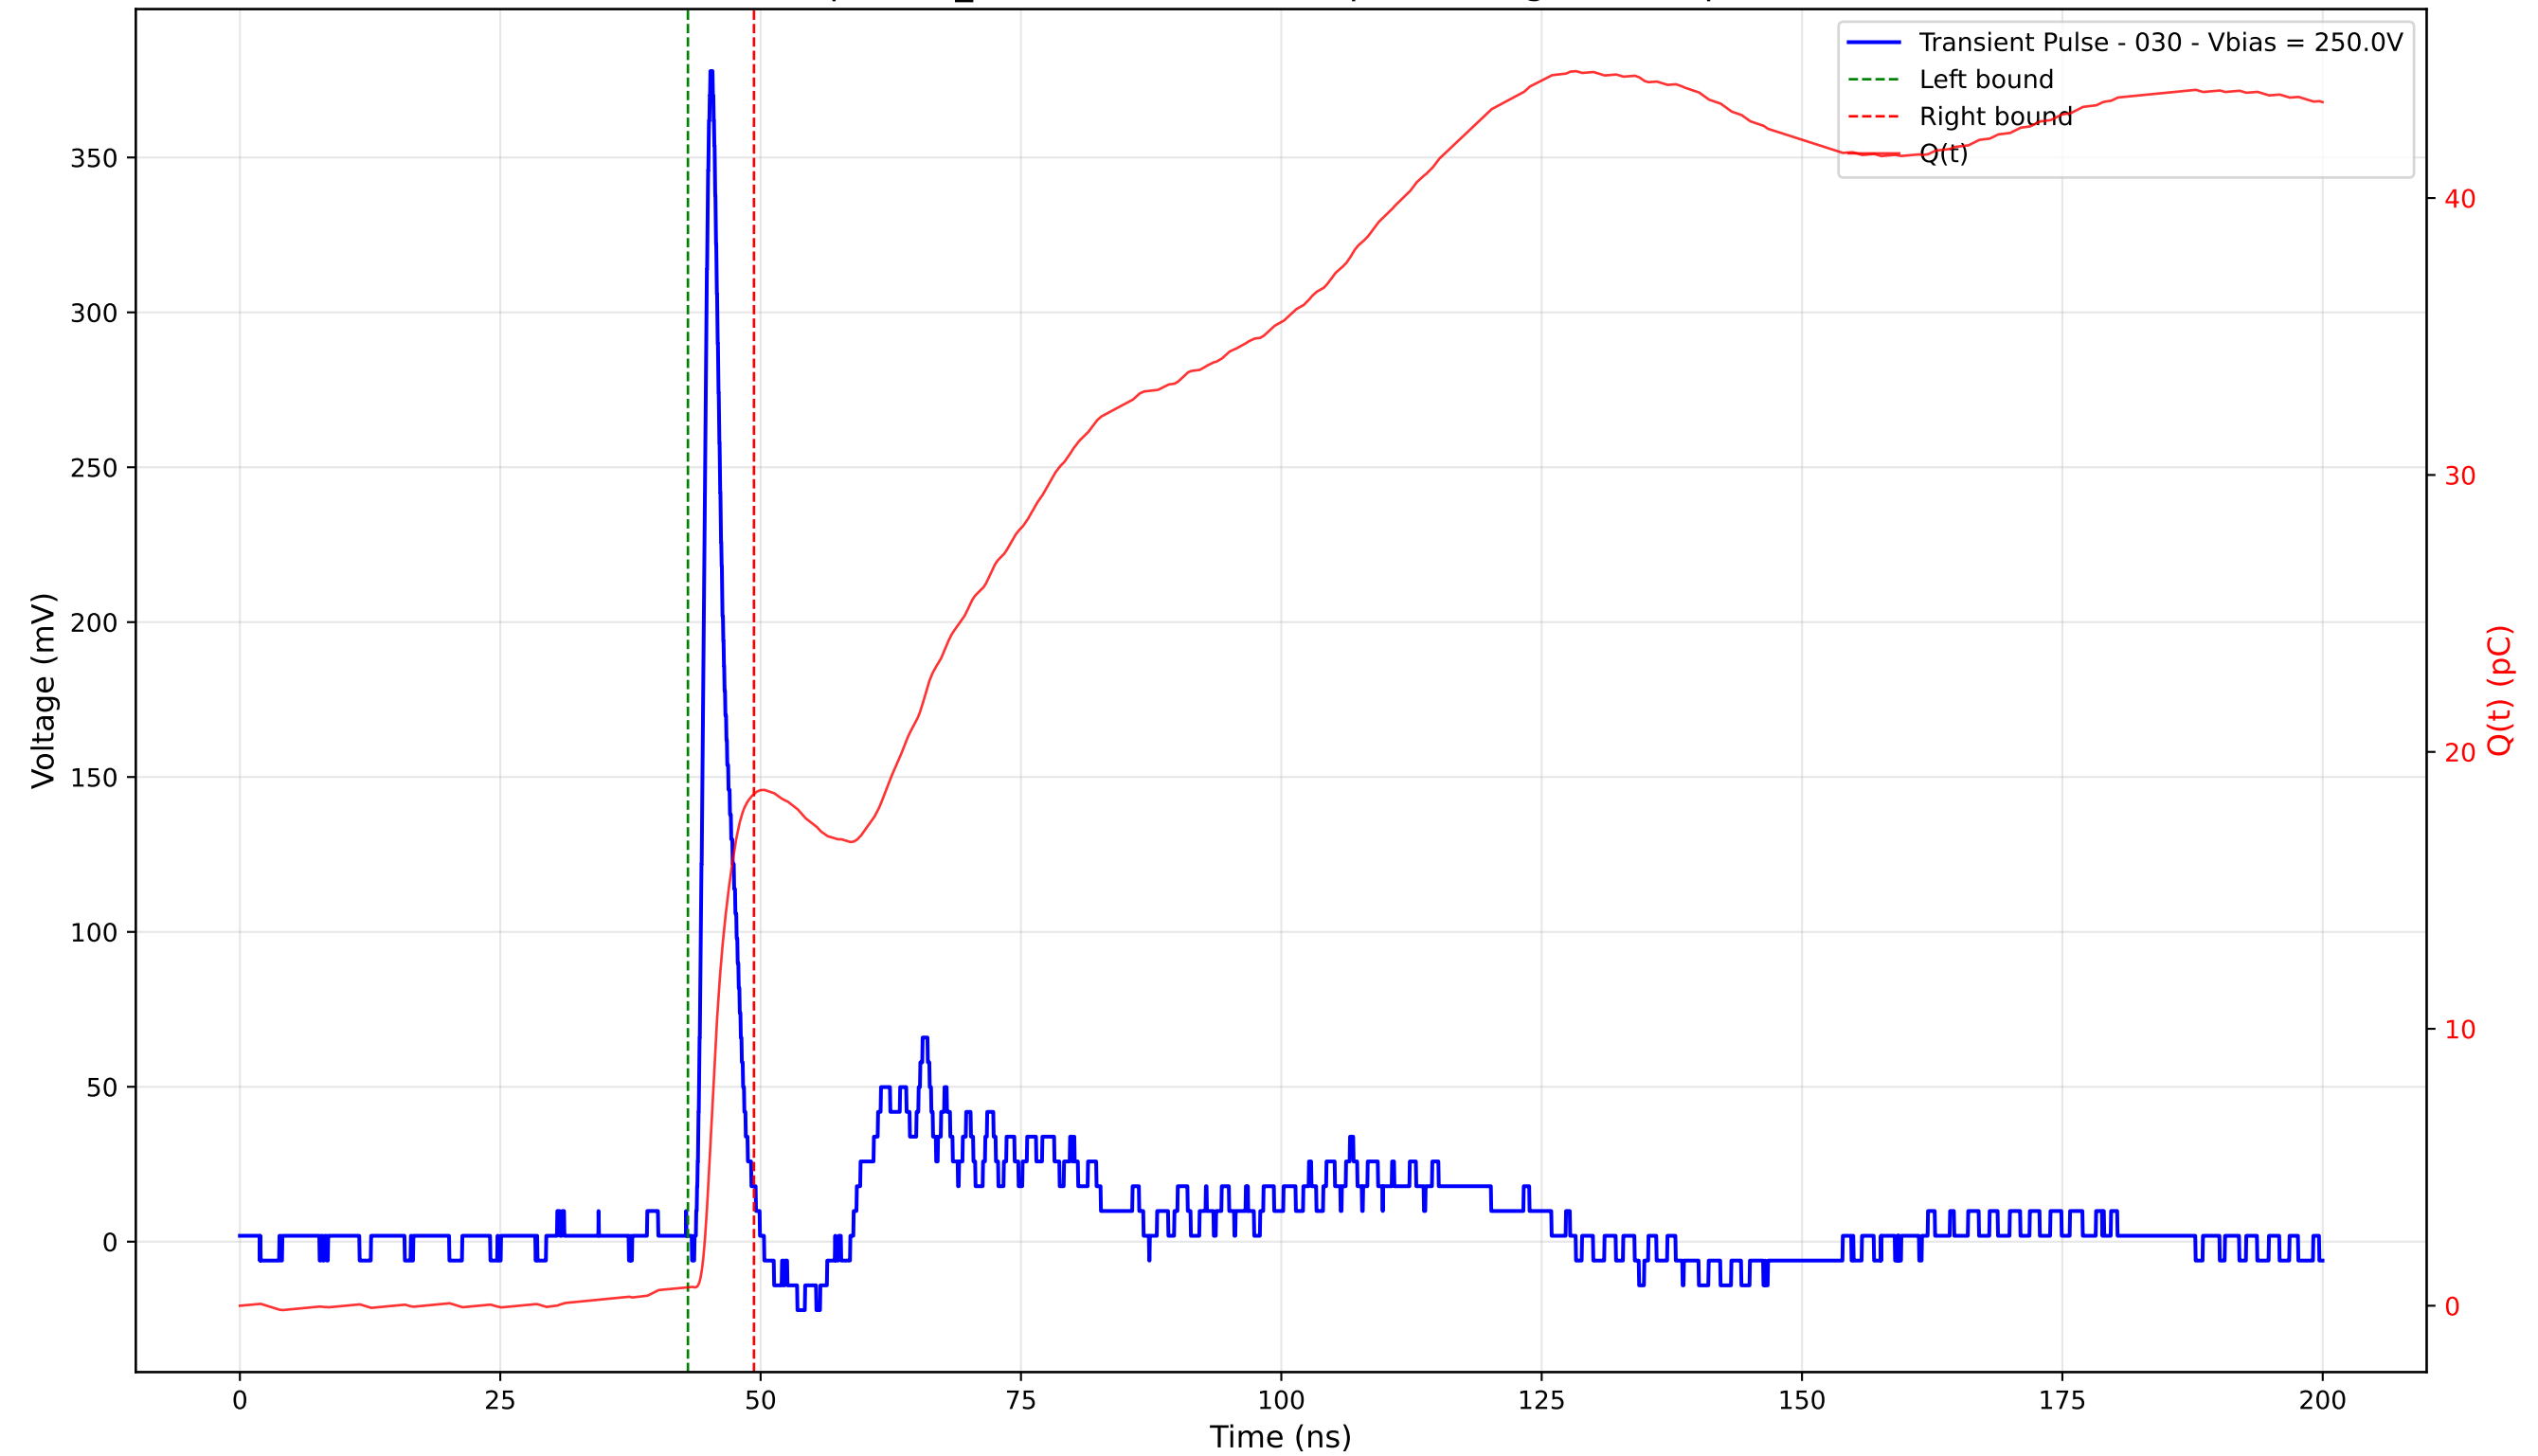


Transient Pulse - Sample: TD_4004 - Position: 70.0 μm - Charge: 23.76 pC - Rise Time: 0.91 ns

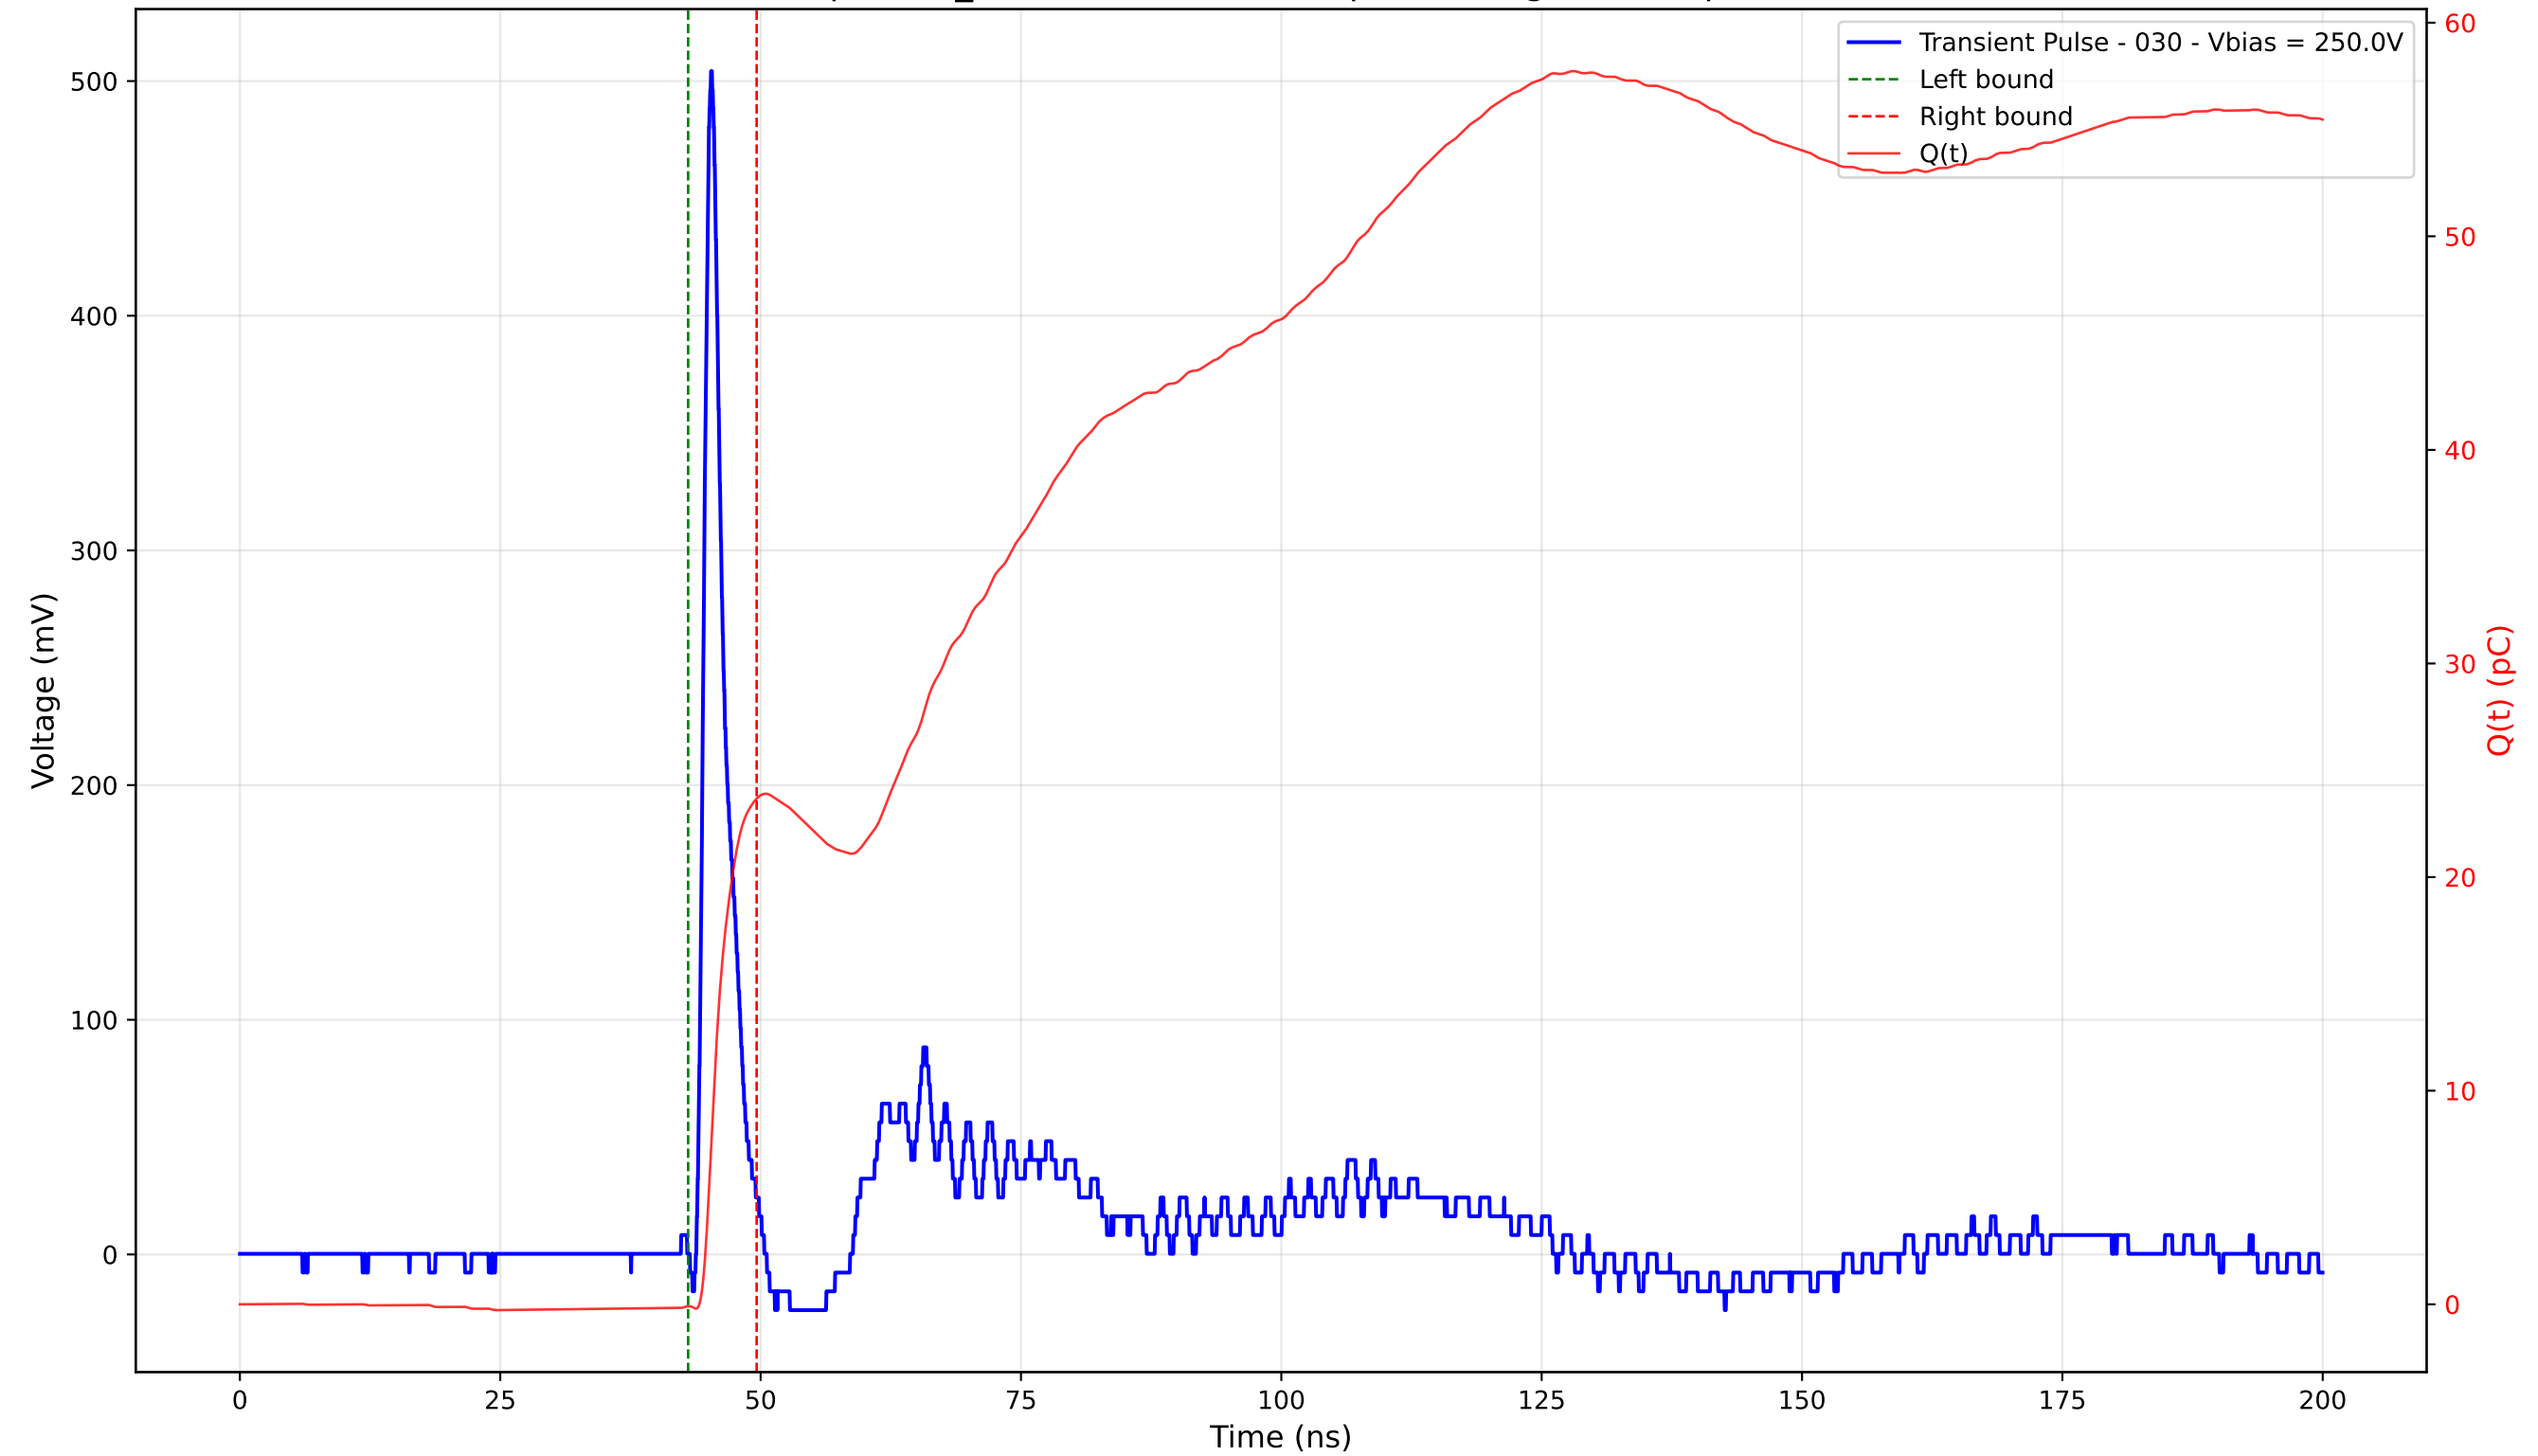


Transient Pulse - Sample: TD_4004 - Position: 75.0 μm - Charge: 28.78 pC - Rise Time: 0.90 ns

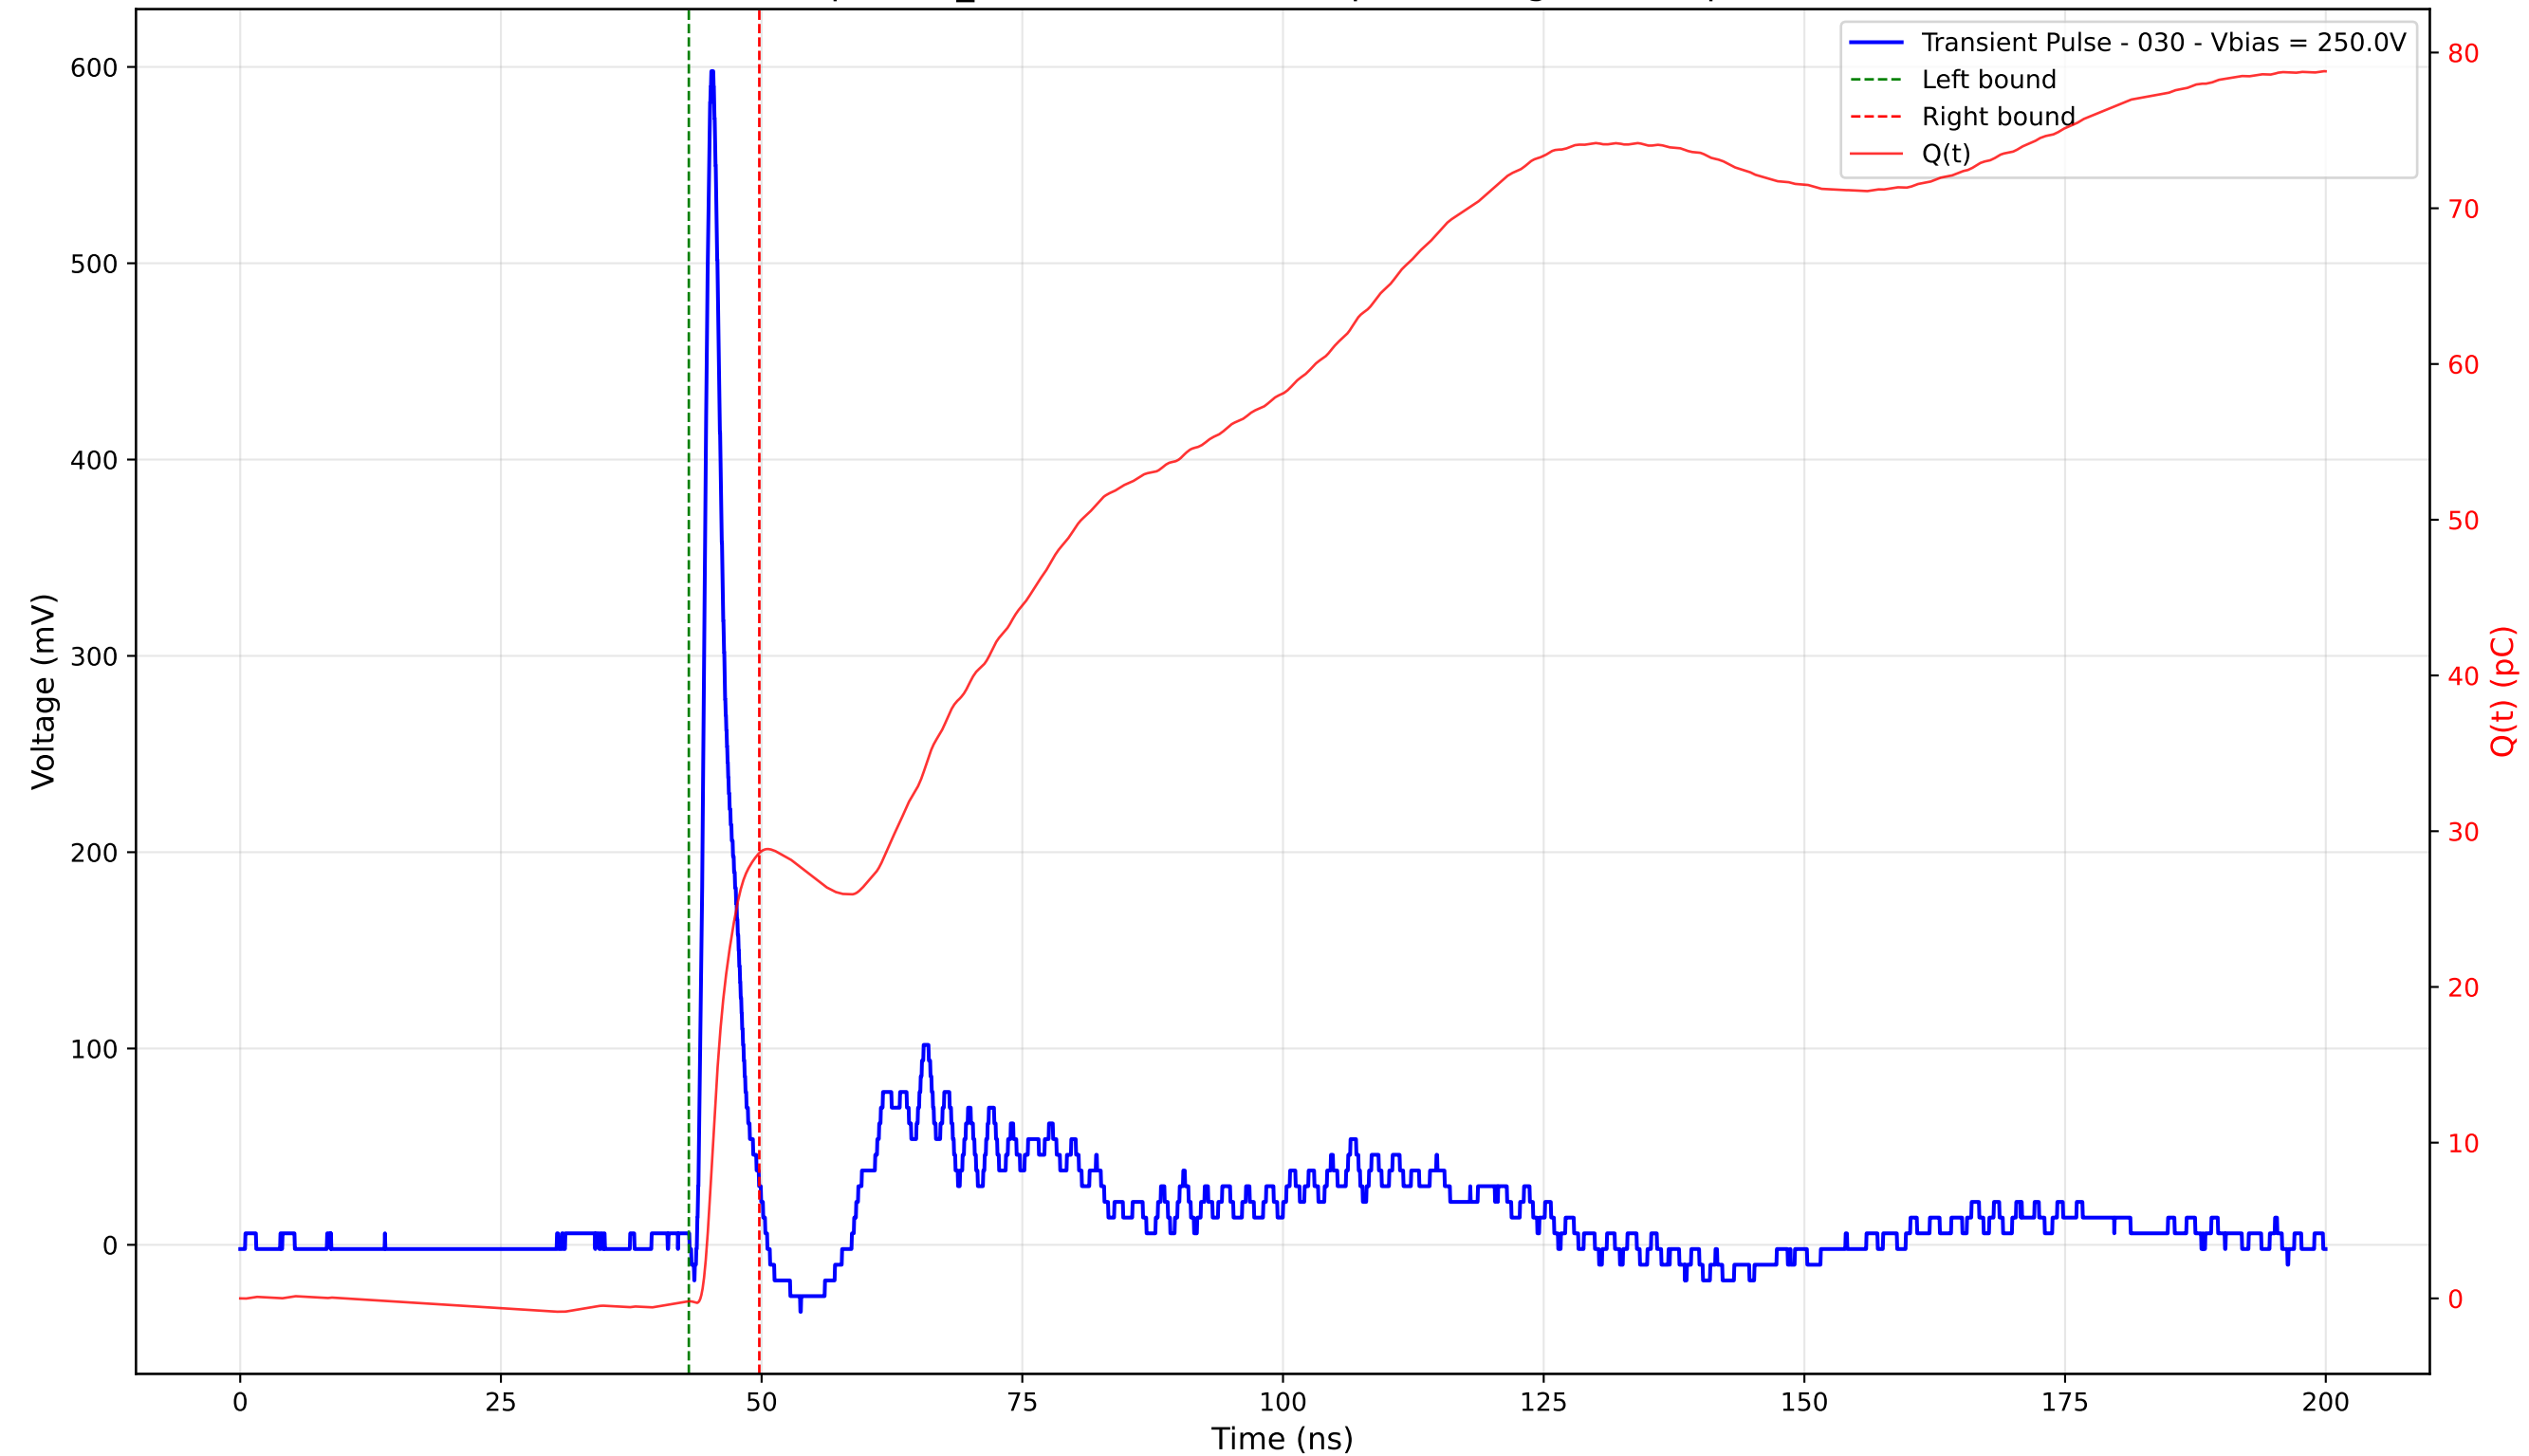


Transient Pulse - Sample: TD_4004 - Position: 80.0 μm - Charge: 32.73 pC - Rise Time: 0.88 ns

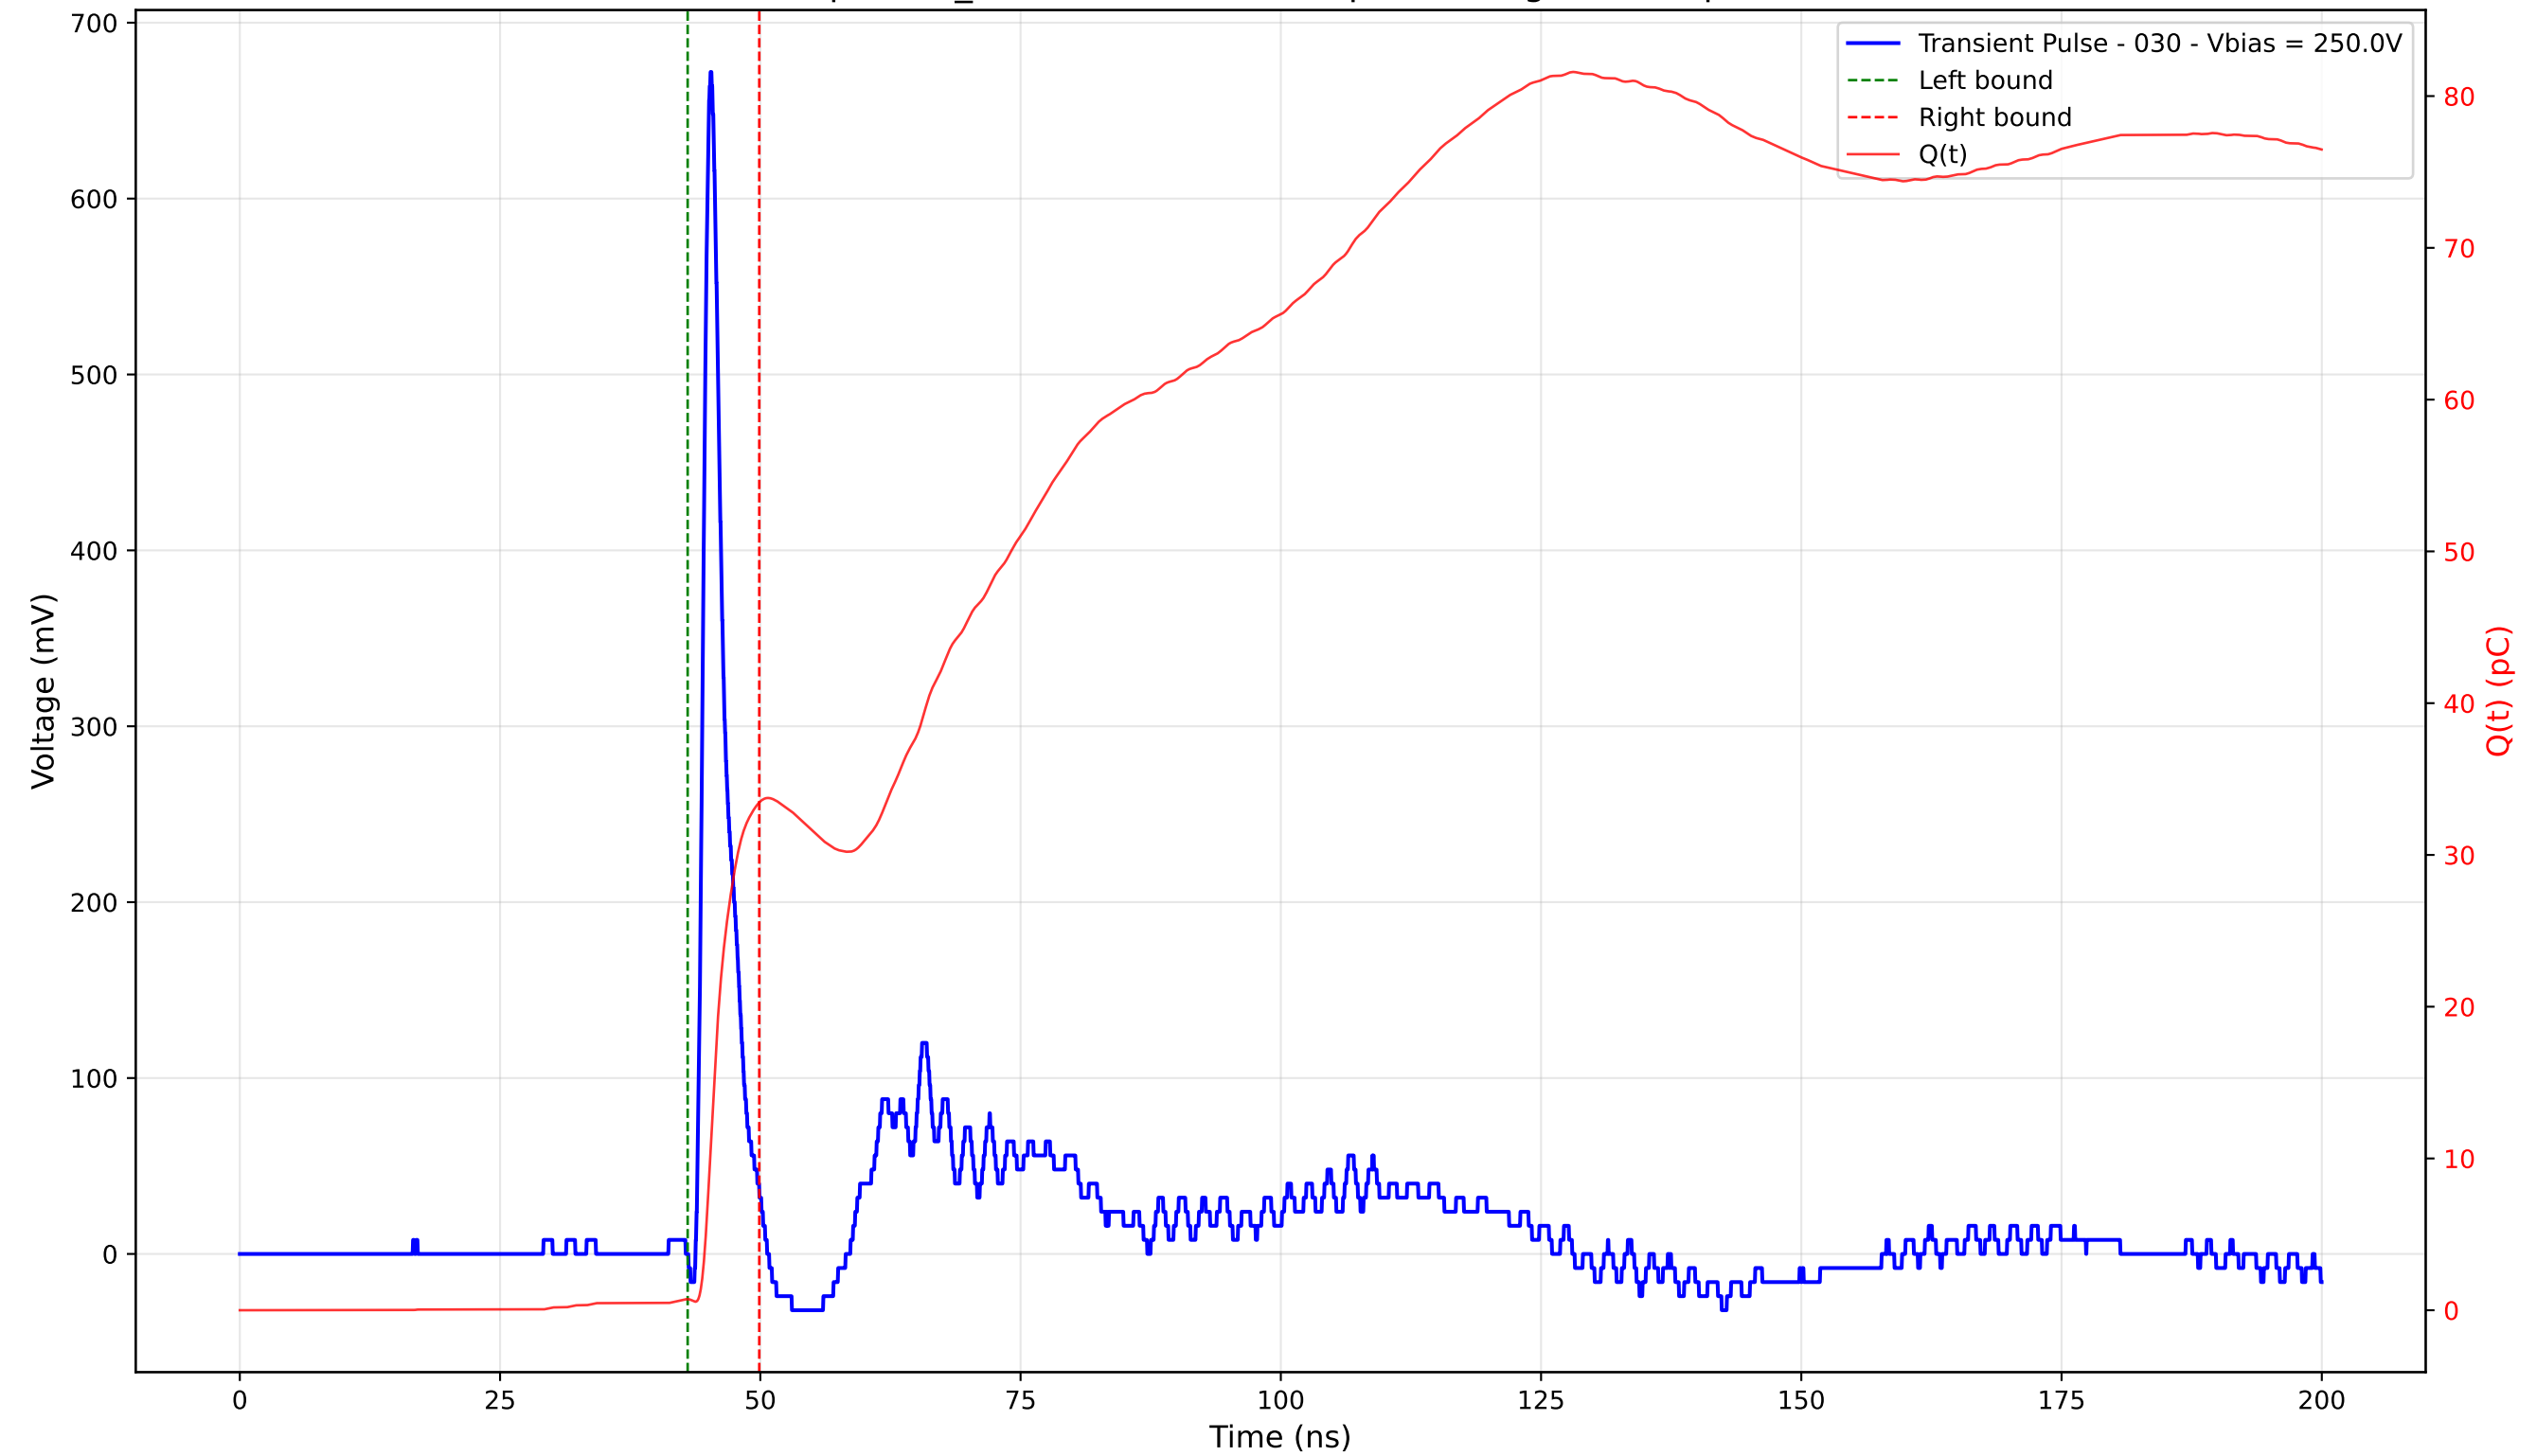


Transient Pulse - Sample: TD_4004 - Position: 85.0 μm - Charge: 35.67 pC - Rise Time: 0.89 ns

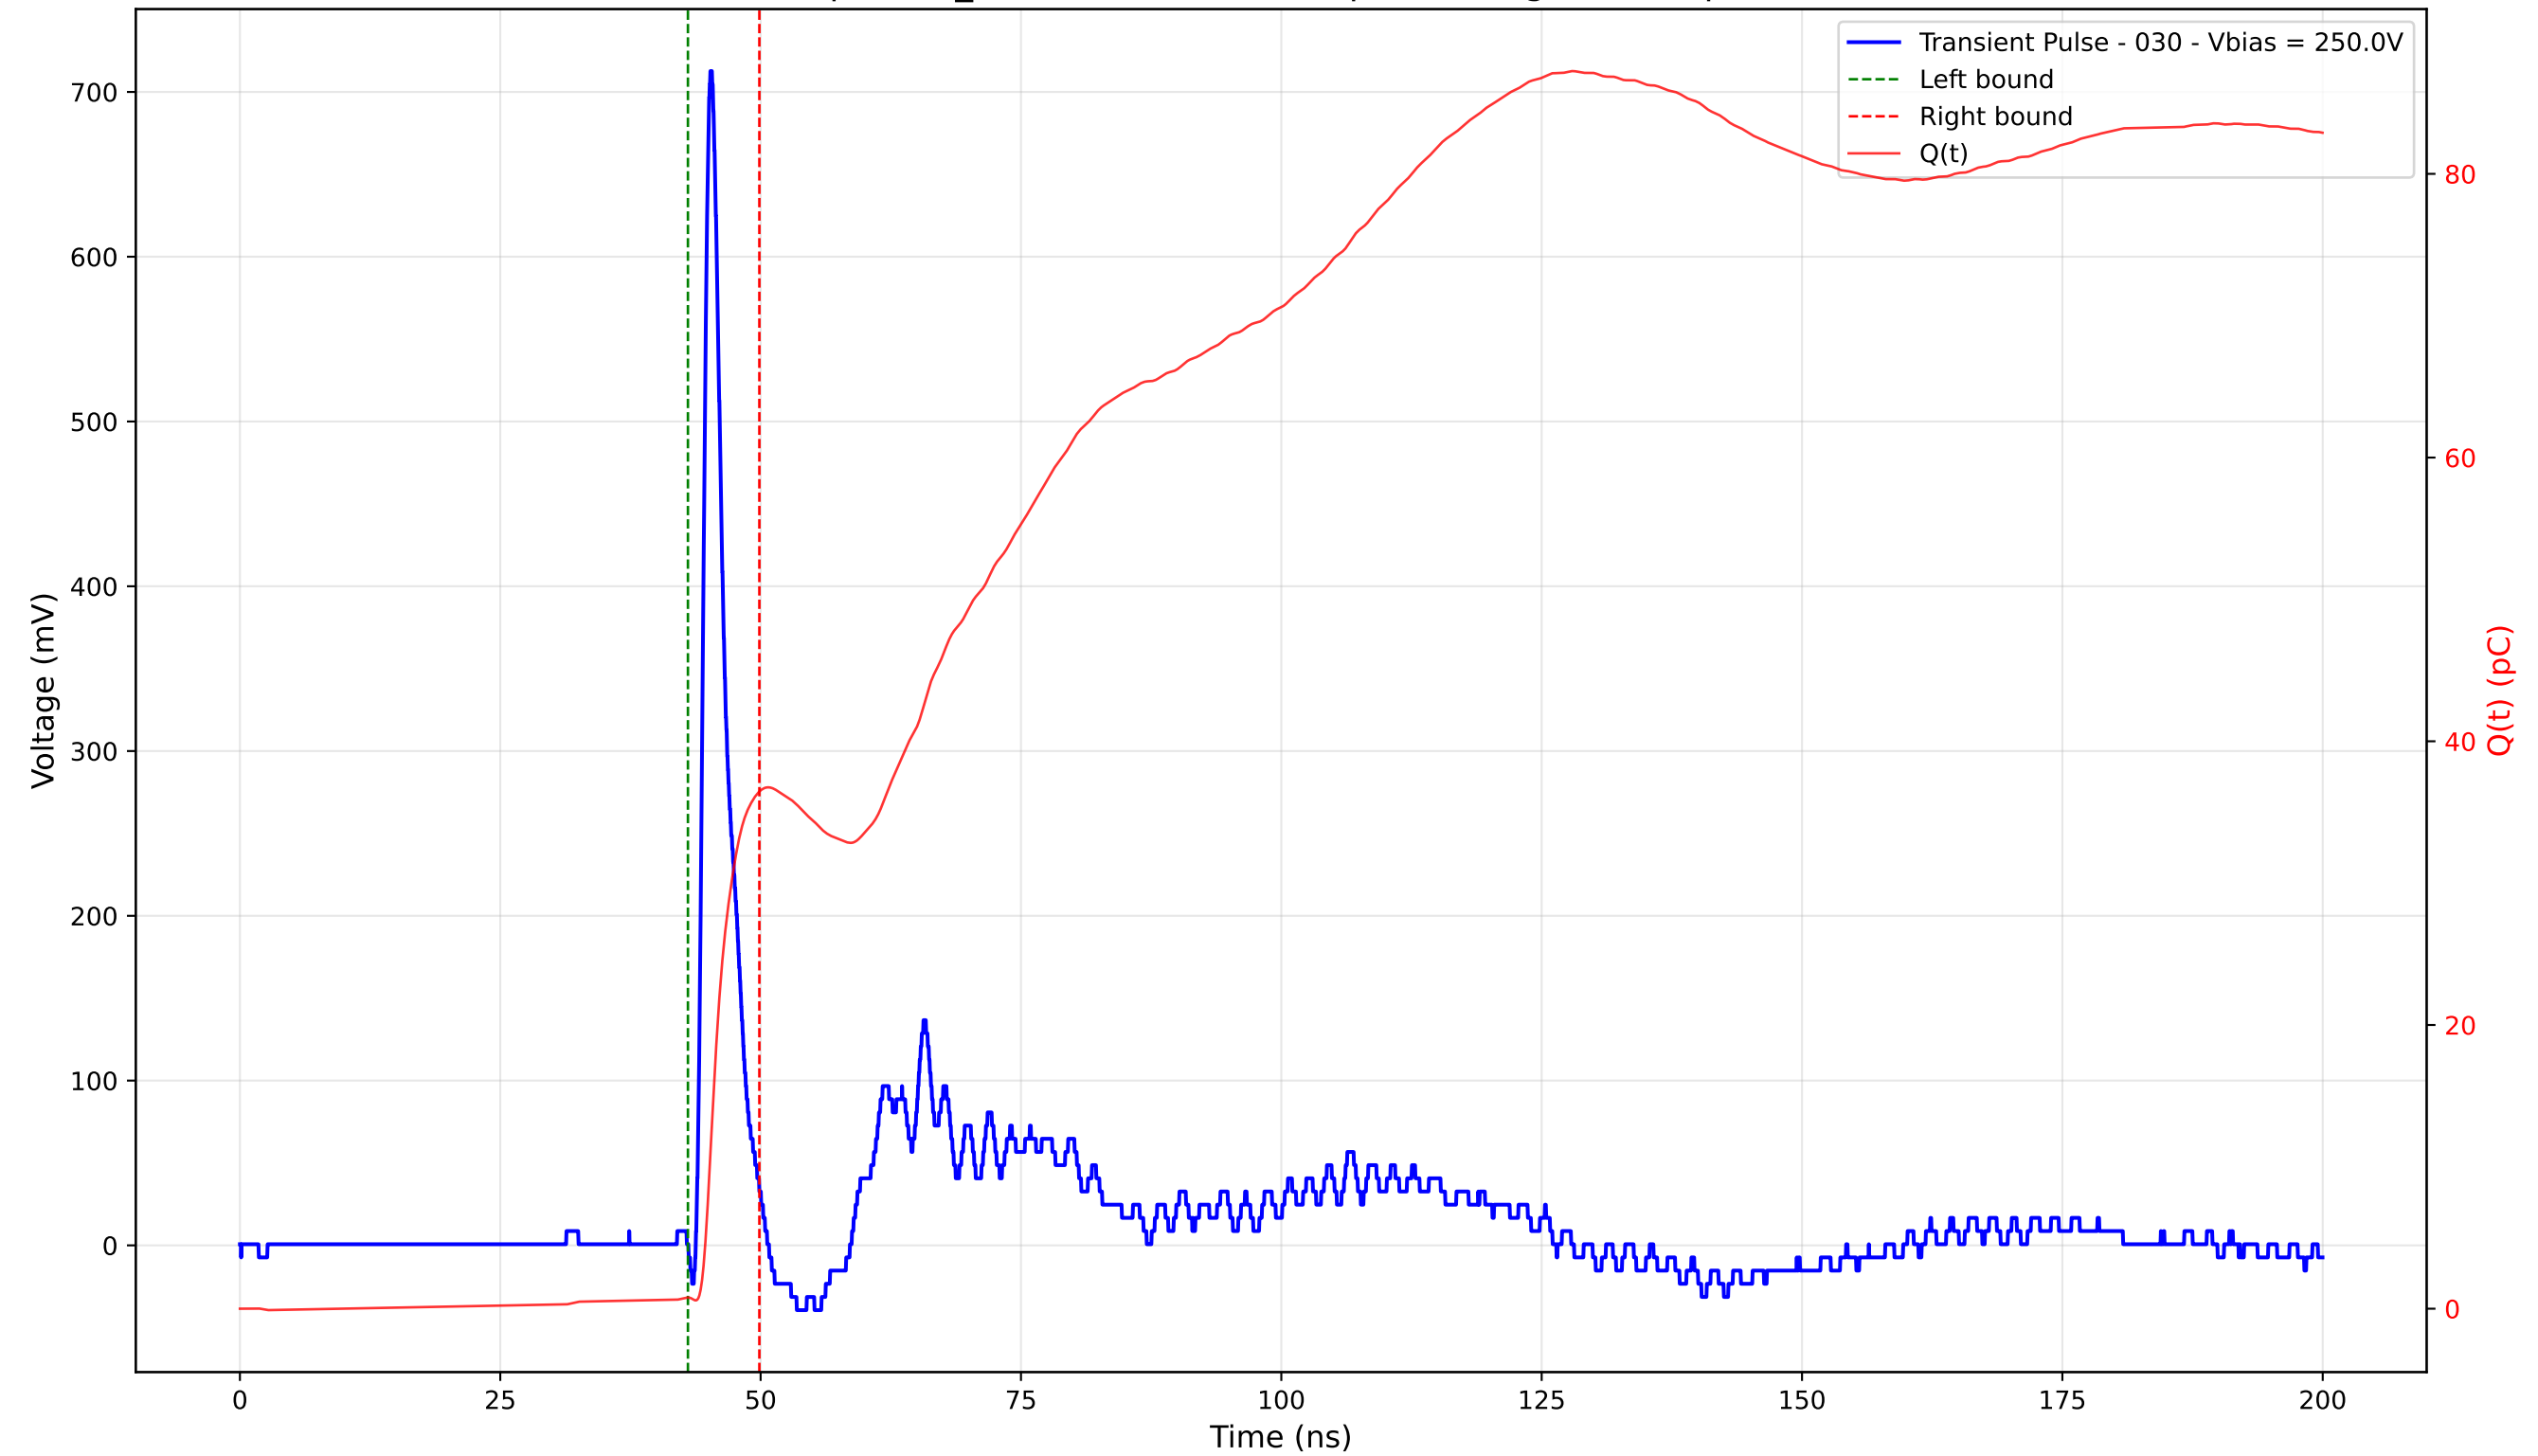


Transient Pulse - Sample: TD_4004 - Position: 90.0 μm - Charge: 38.49 pC - Rise Time: 0.89 ns

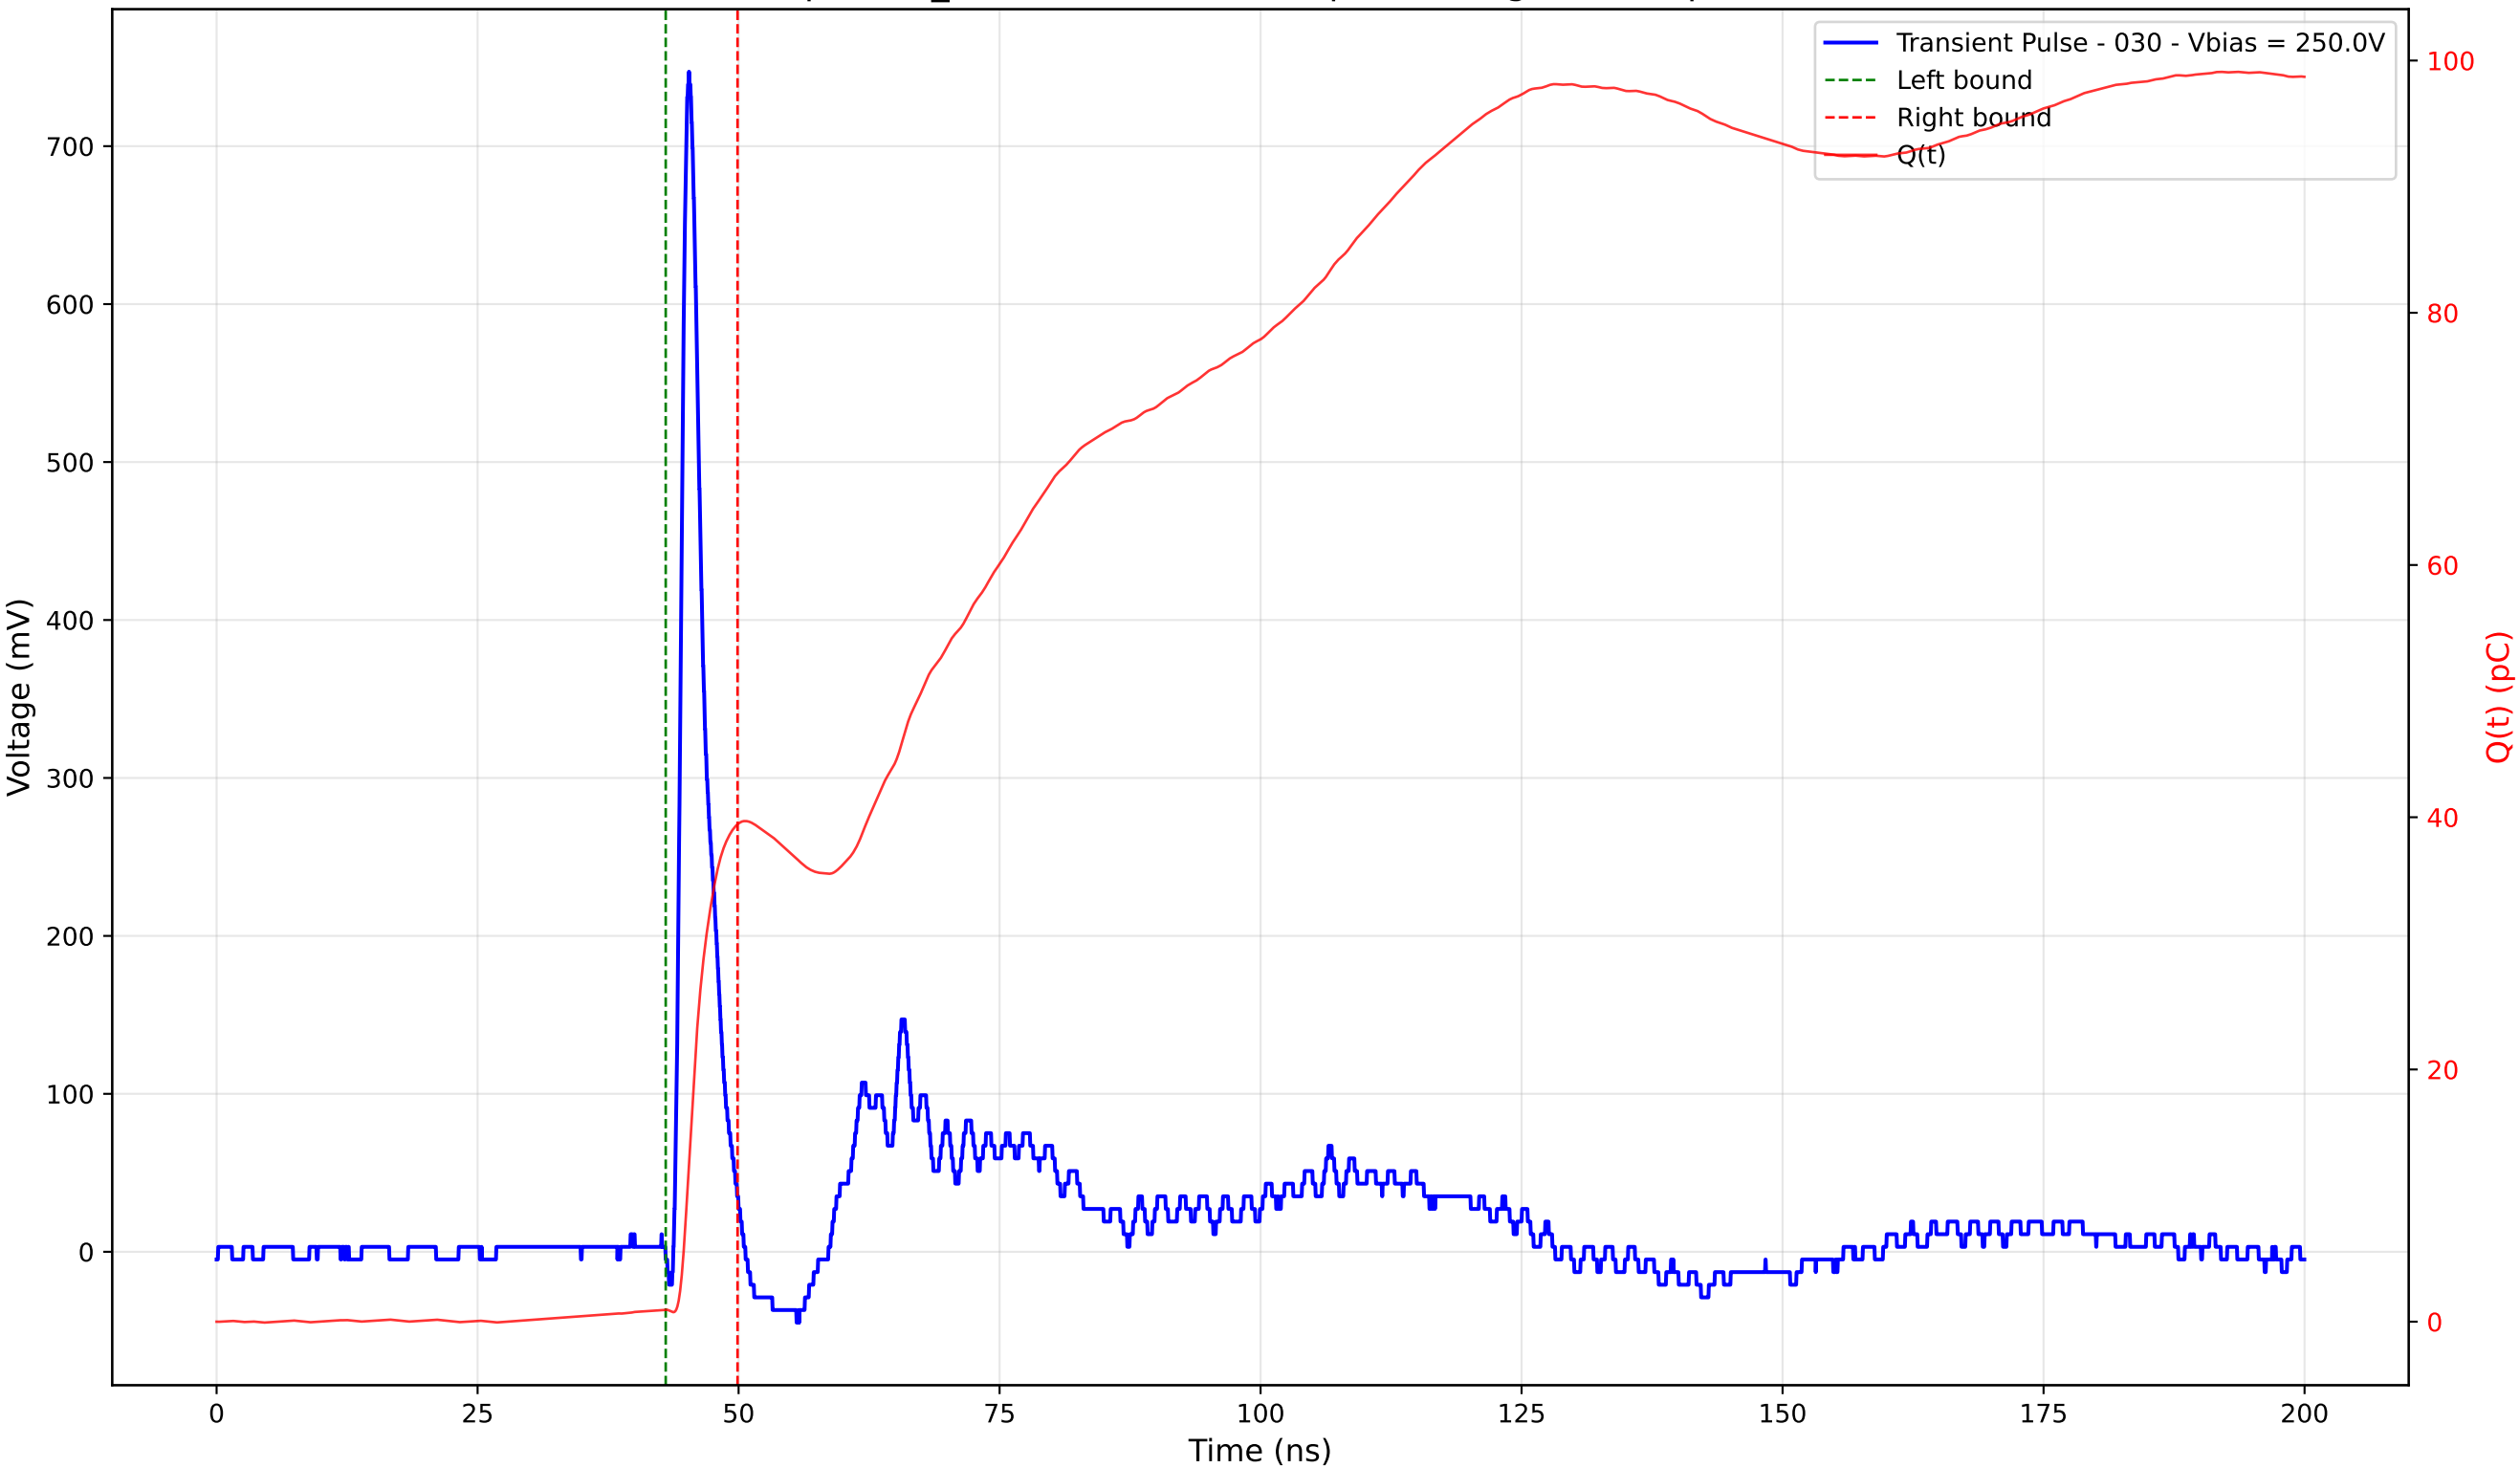


Transient Pulse - Sample: TD_4004 - Position: 95.0 μm - Charge: 41.29 pC - Rise Time: 0.88 ns

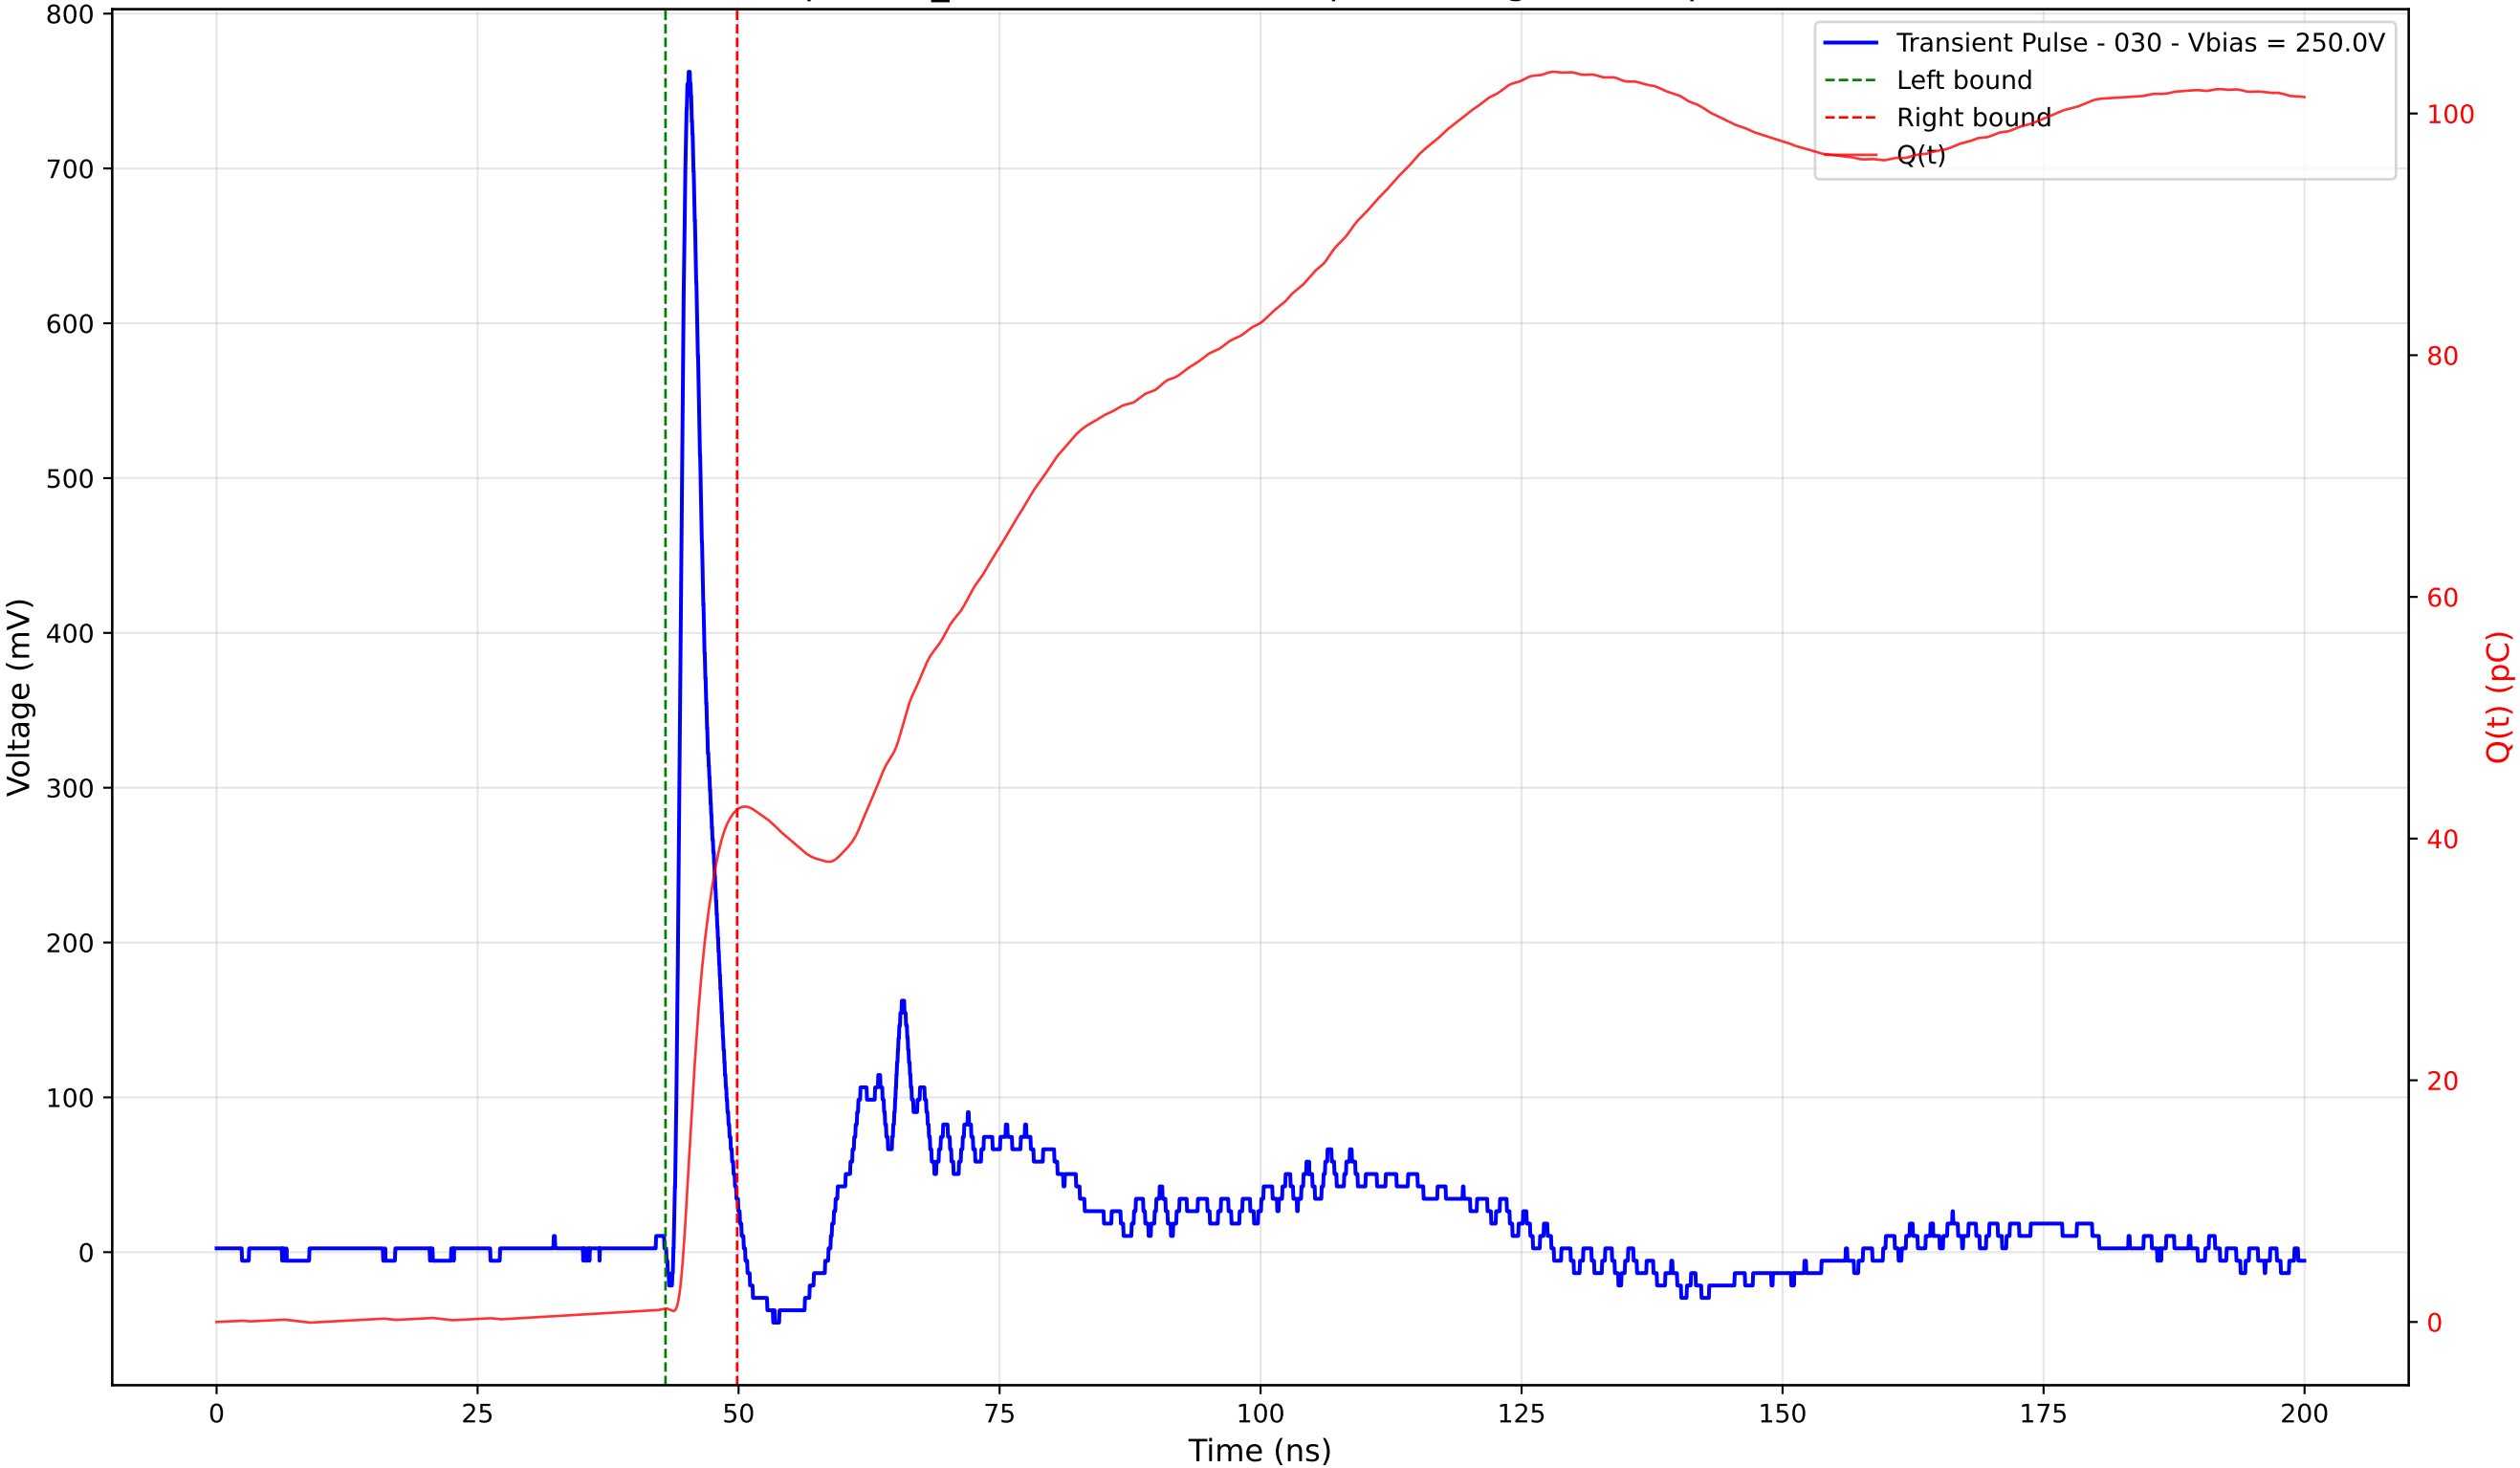


Transient Pulse - Sample: TD_4004 - Position: 100.0 μm - Charge: 43.83 pC - Rise Time: 0.87 ns

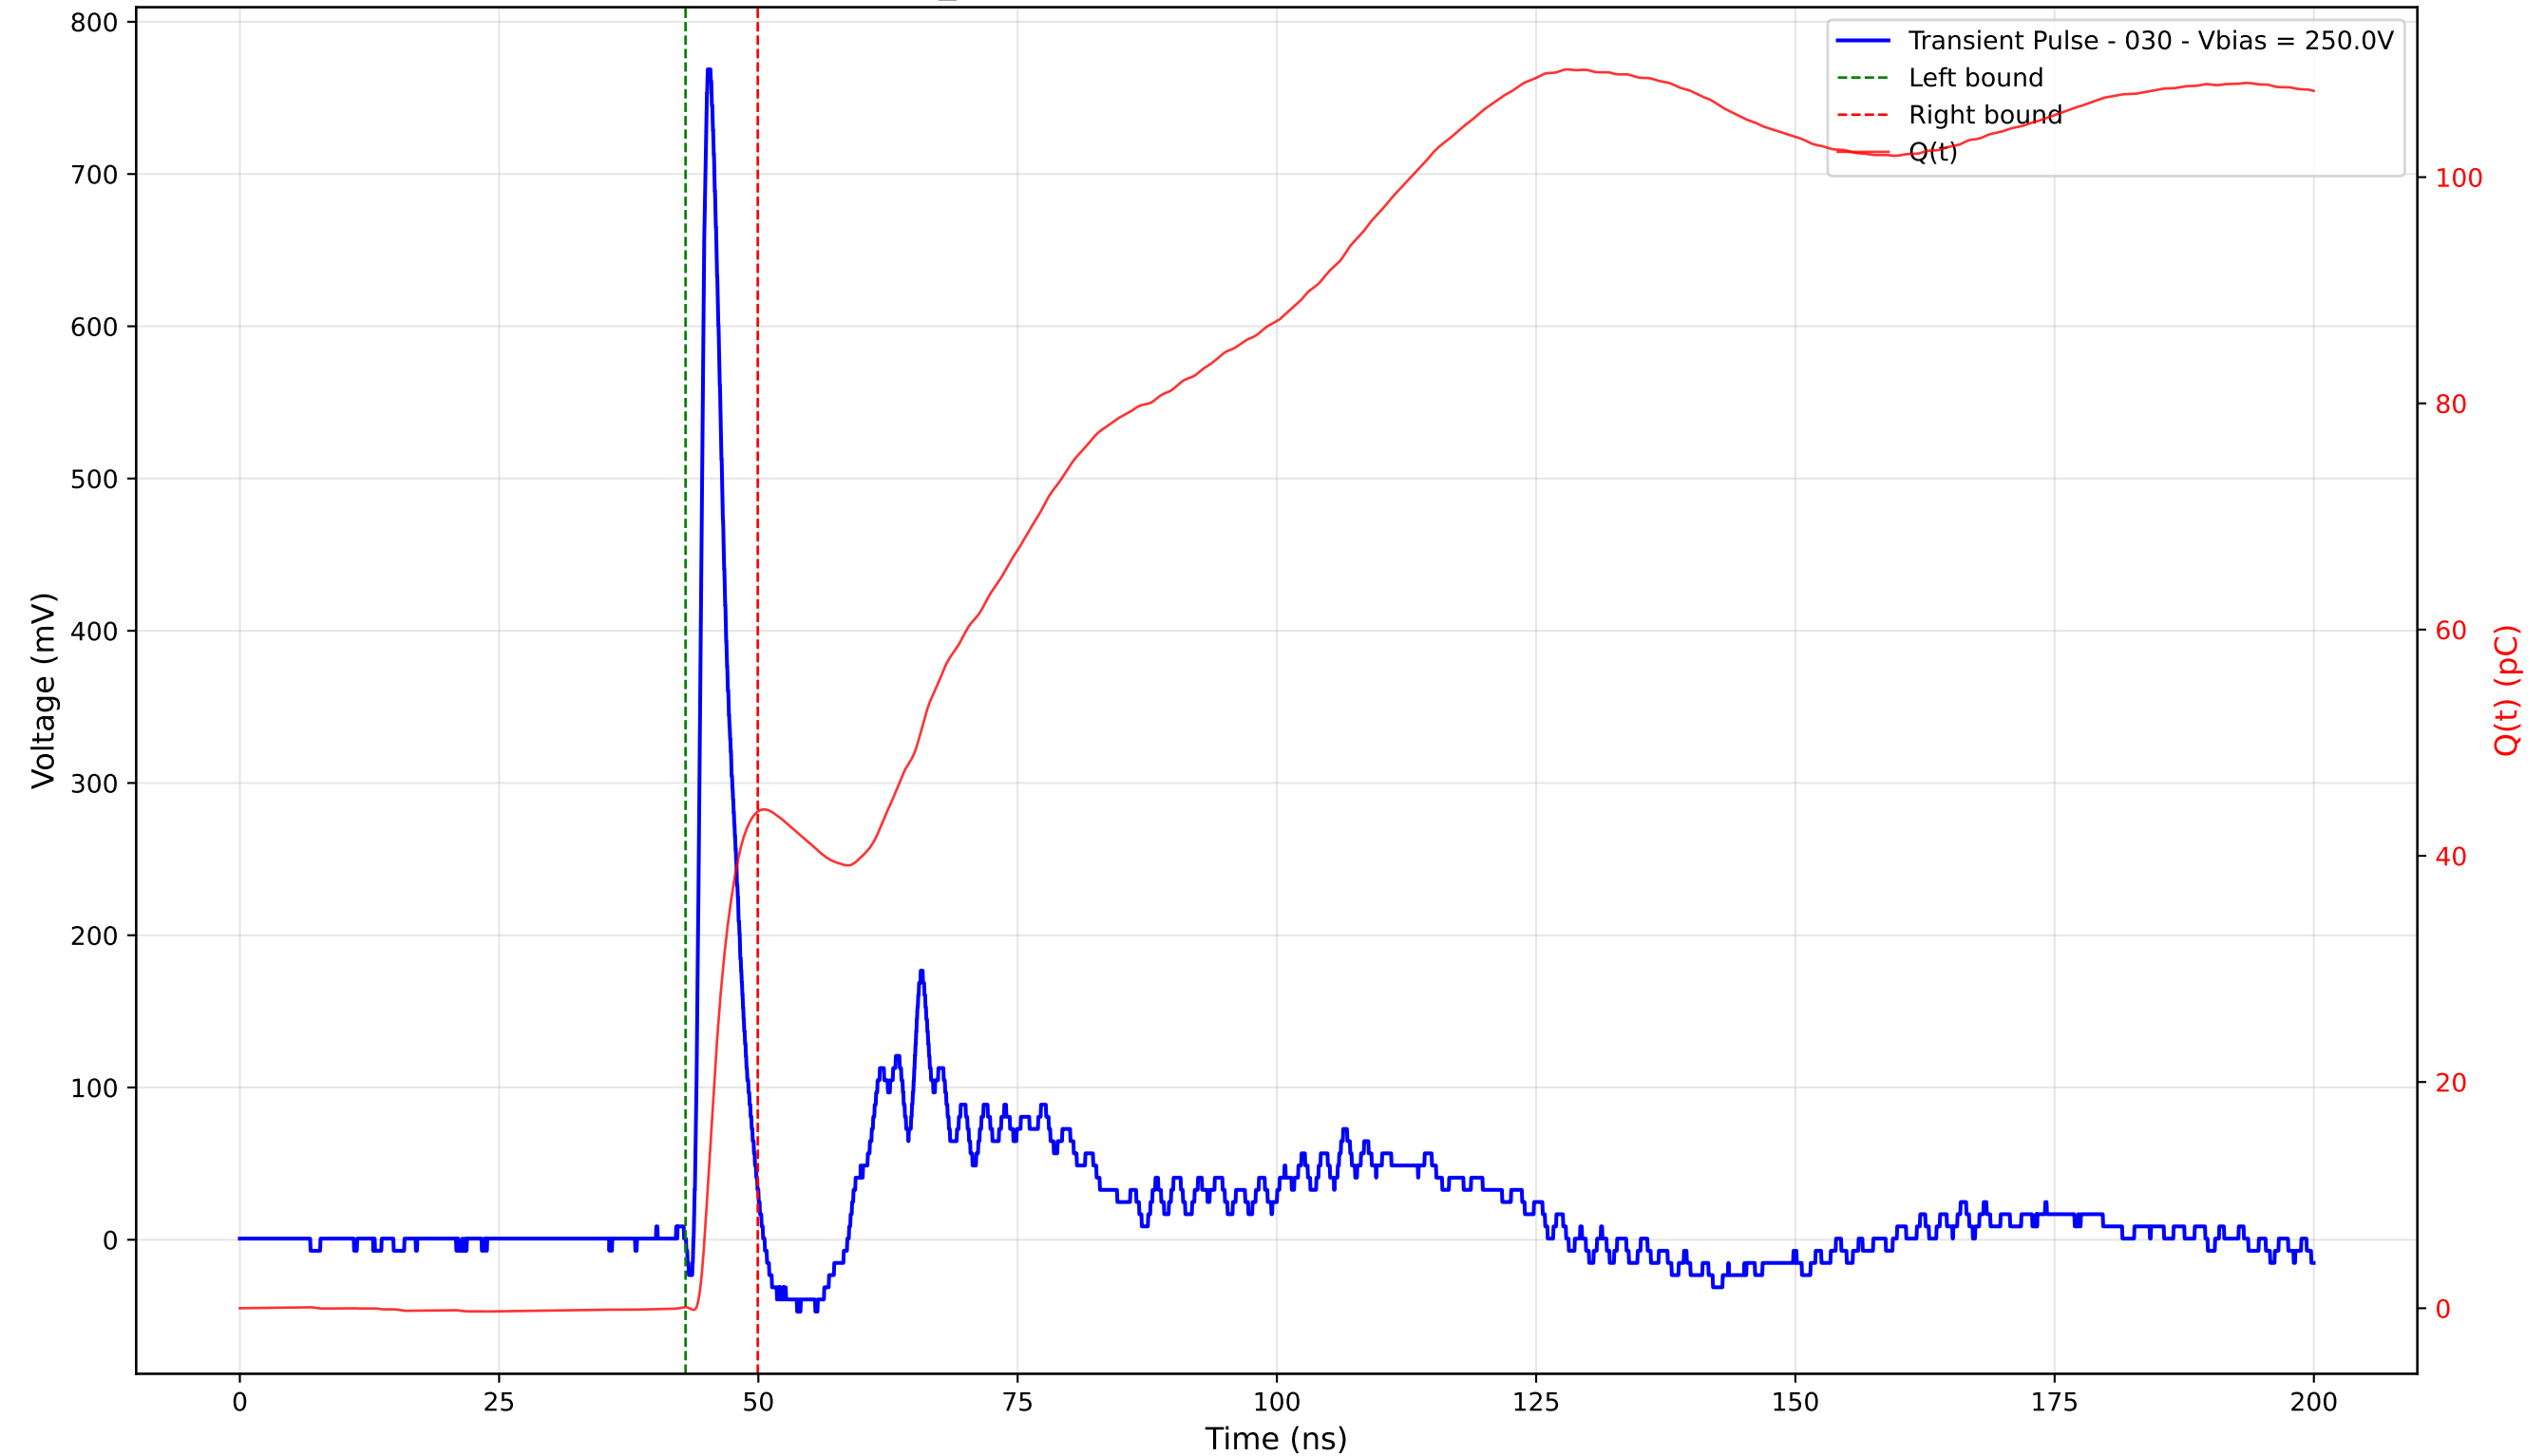


Transient Pulse - Sample: TD_4004 - Position: 105.0 μm - Charge: 46.01 pC - Rise Time: 0.88 ns

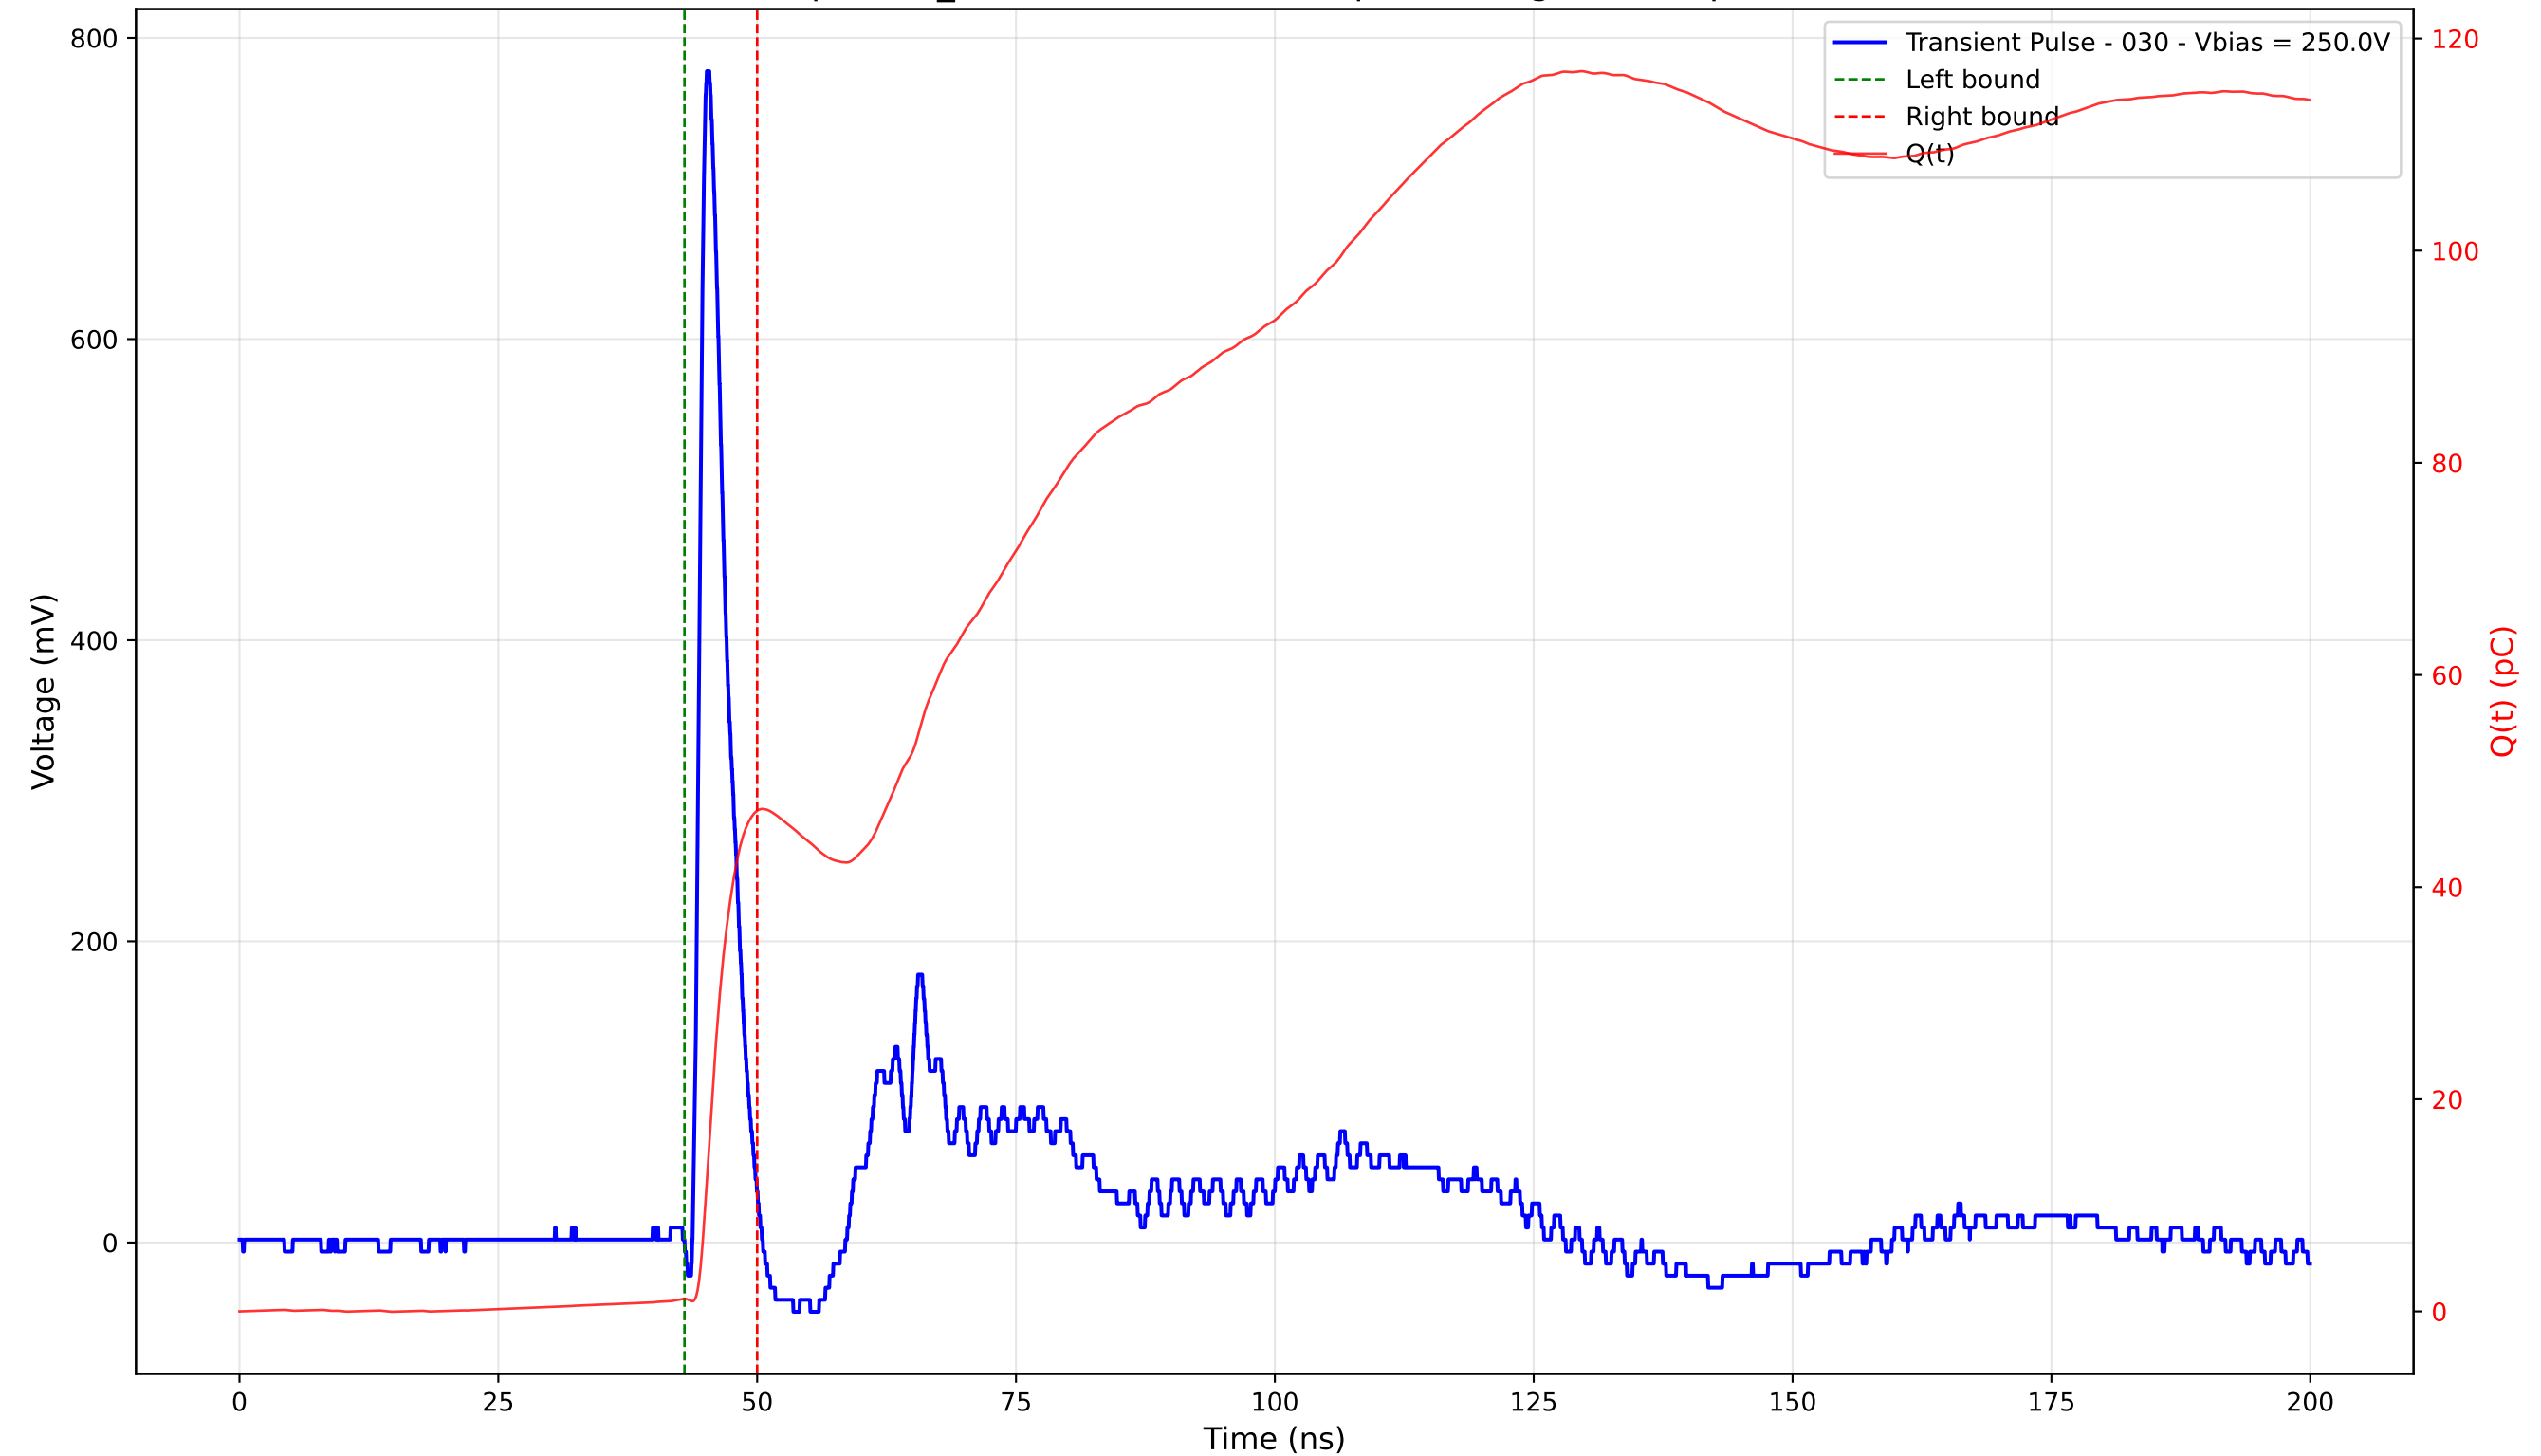


Transient Pulse - Sample: TD_4004 - Position: 110.0 μm - Charge: 46.96 pC - Rise Time: 0.87 ns

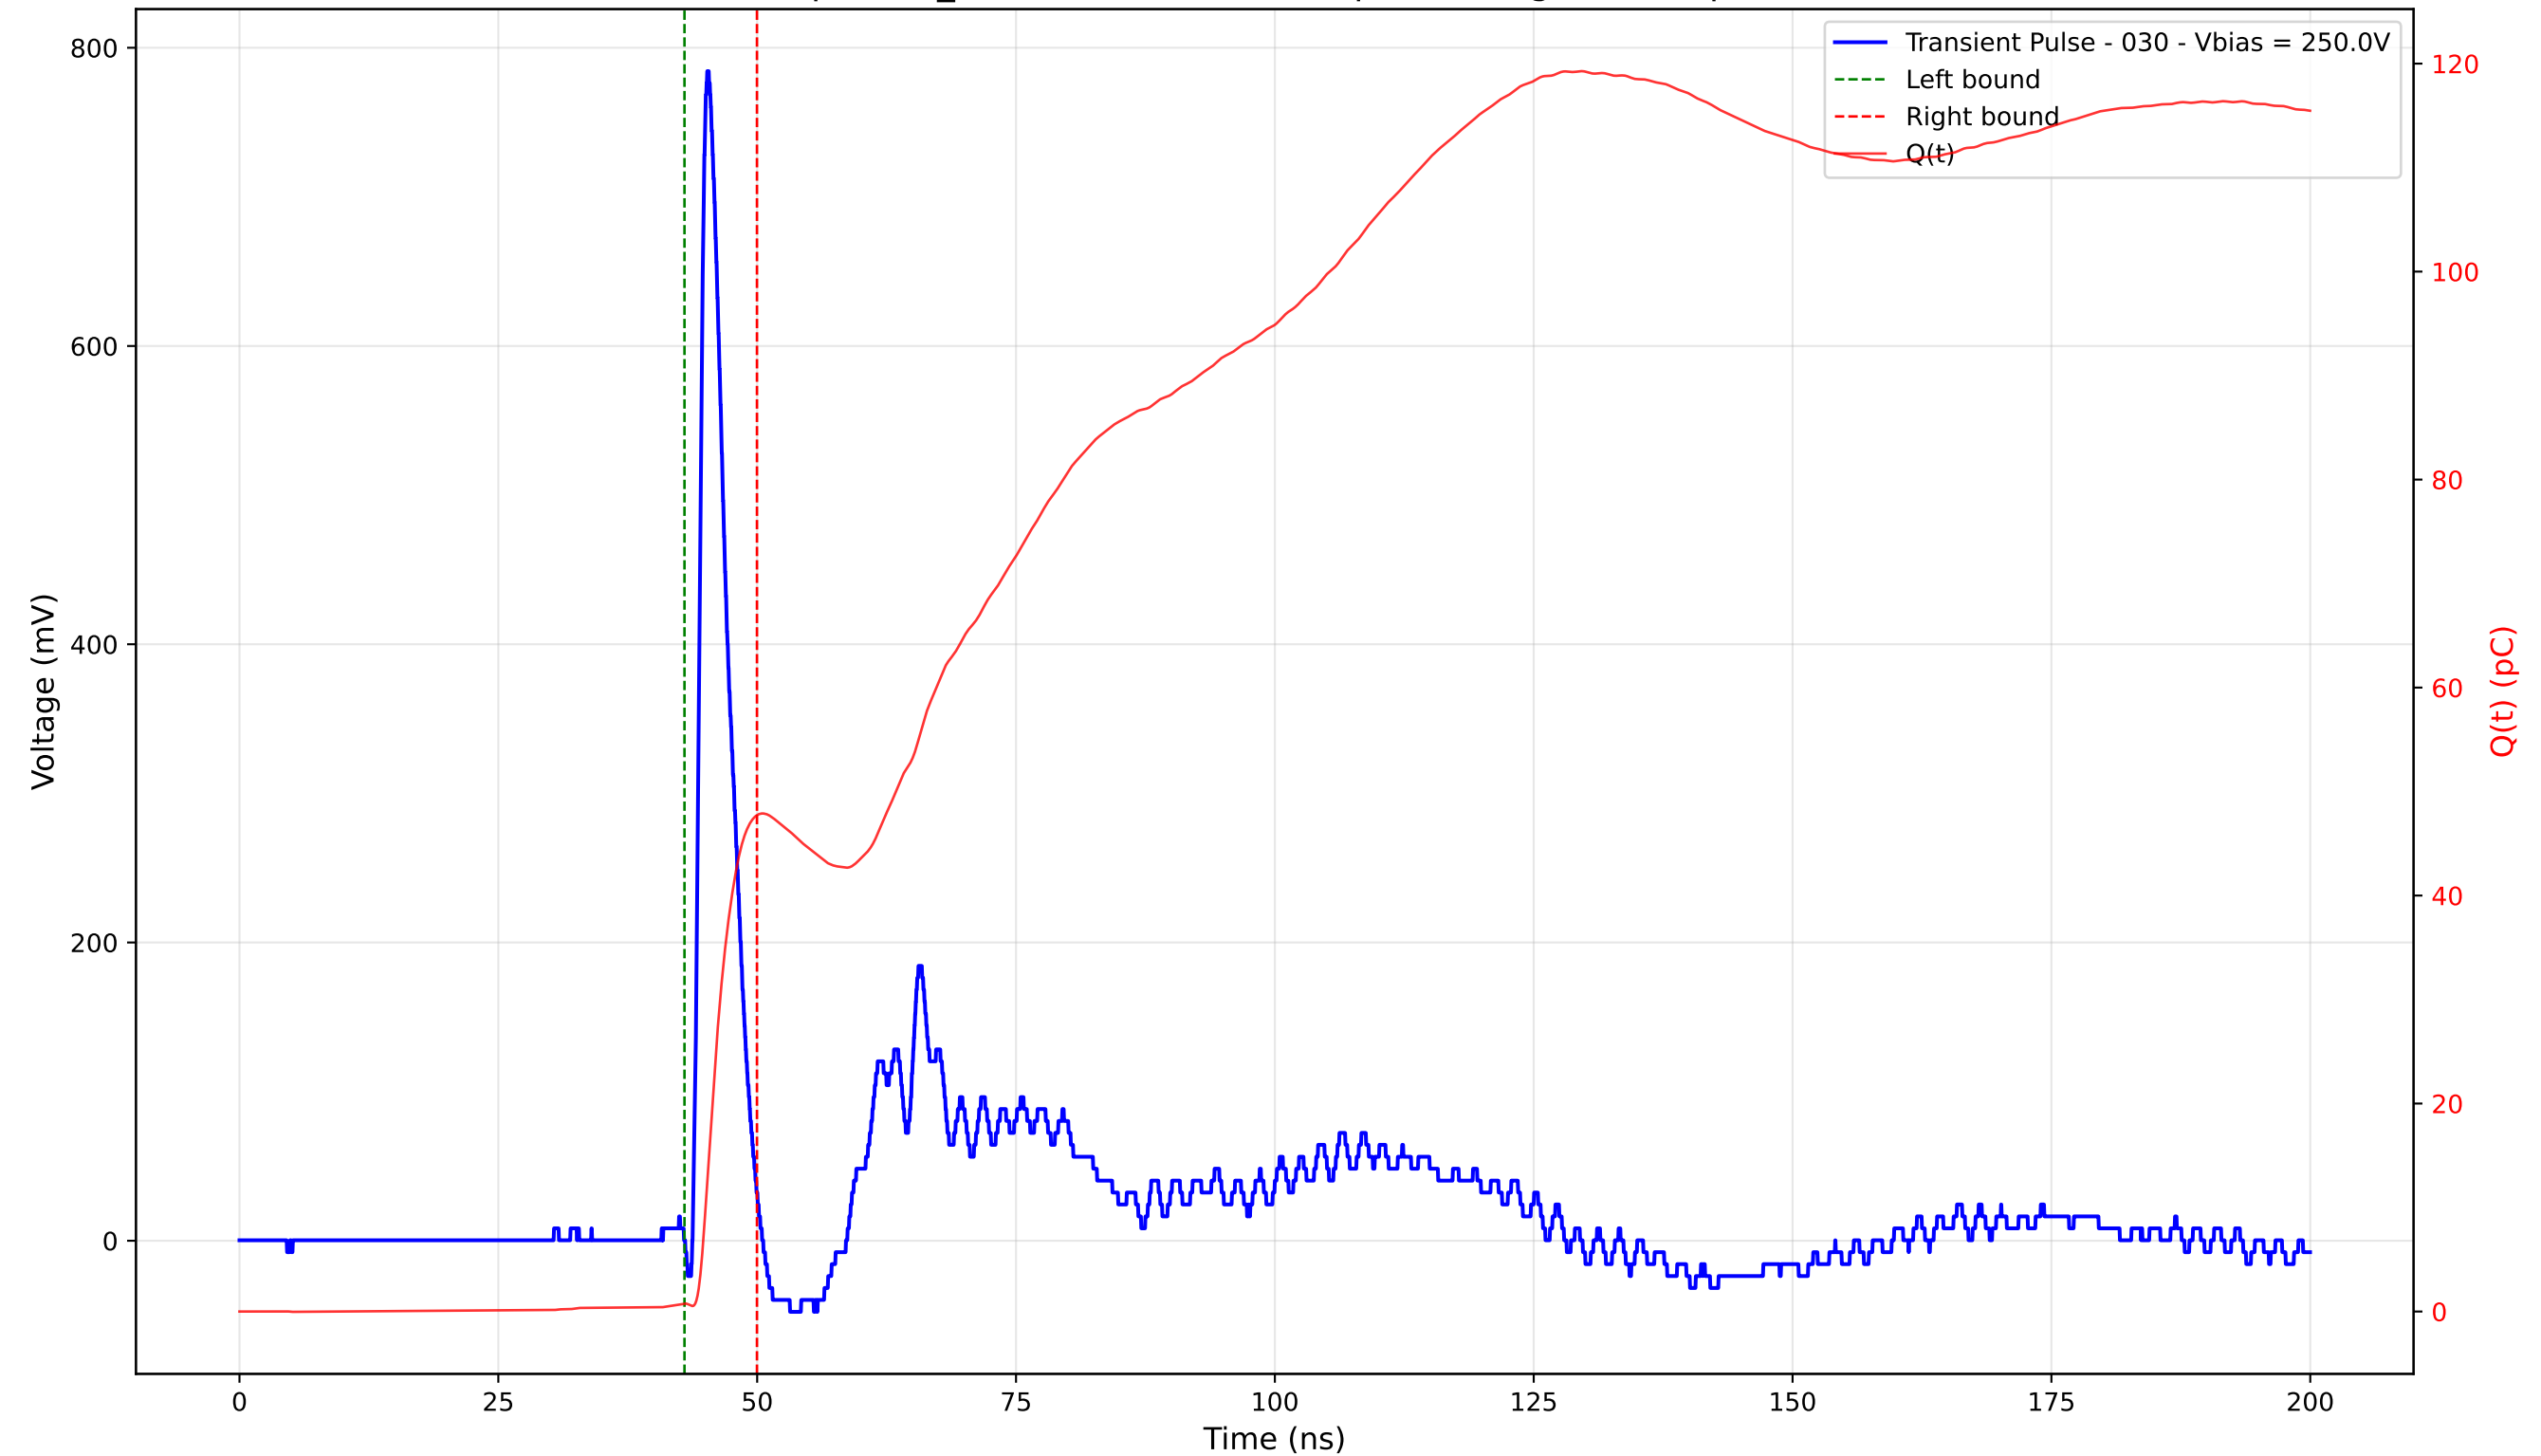


Transient Pulse - Sample: TD_4004 - Position: 115.0 μm - Charge: 46.95 pC - Rise Time: 0.89 ns

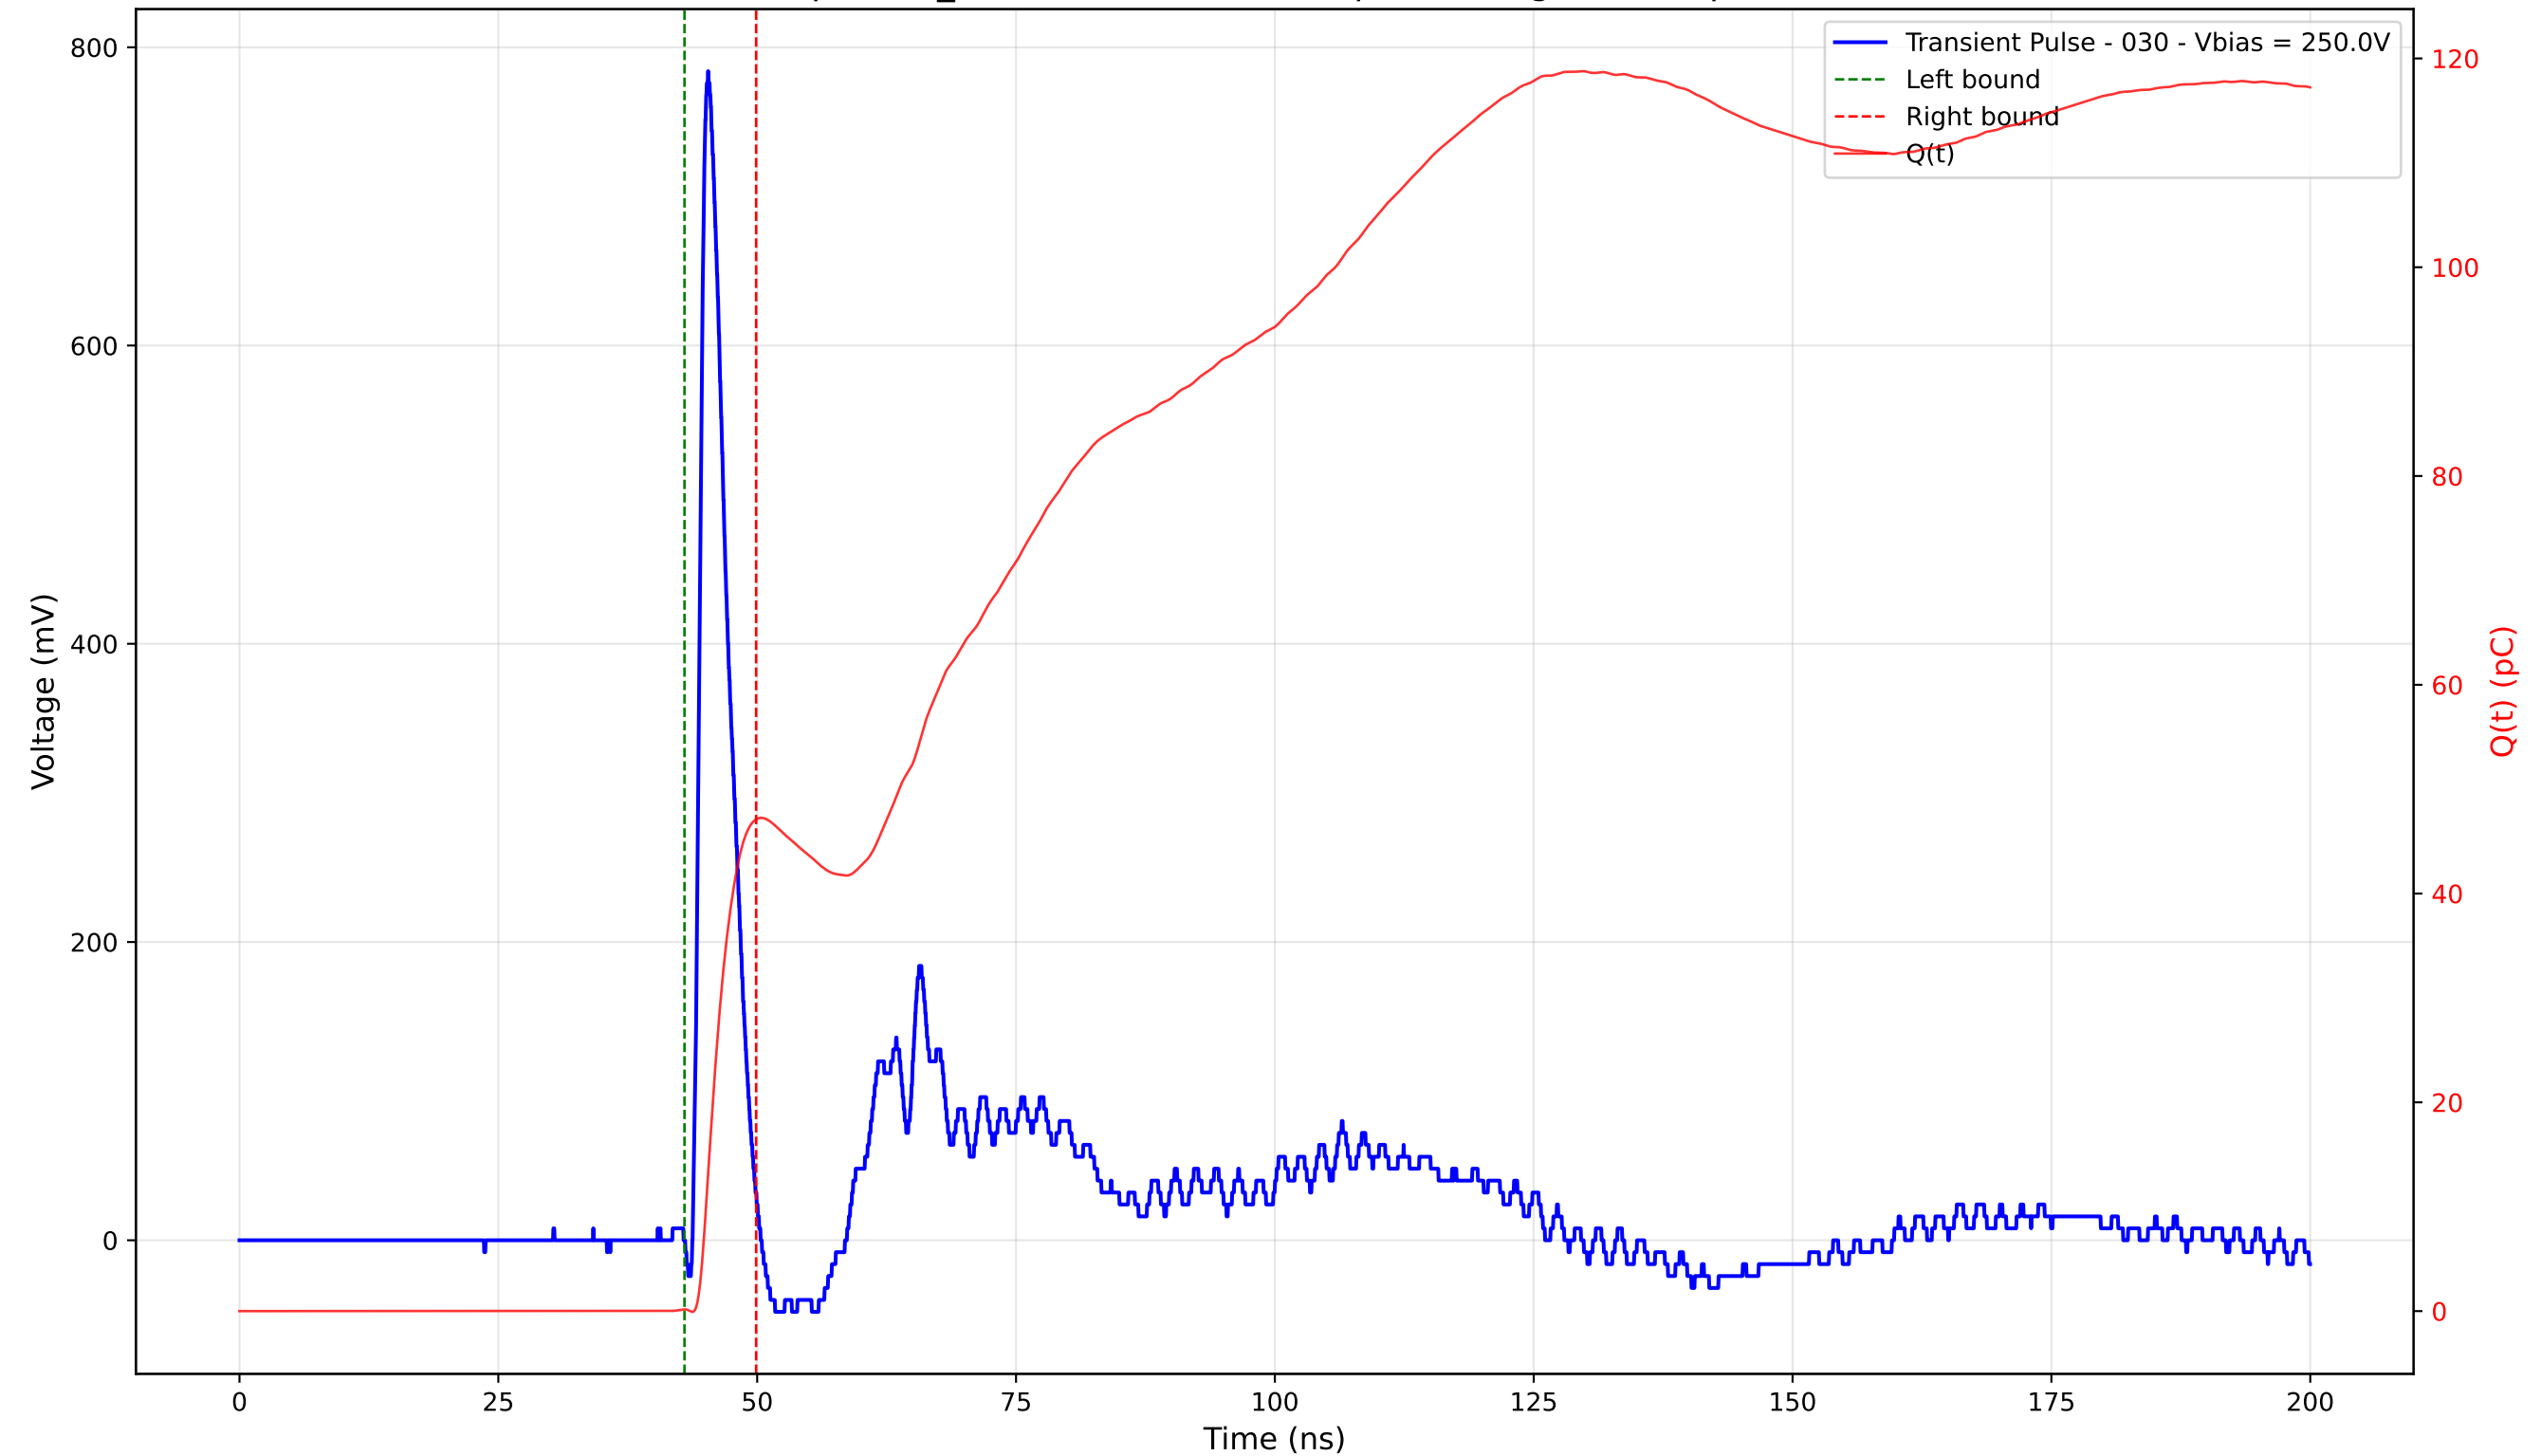


Transient Pulse - Sample: TD_4004 - Position: 120.0 μm - Charge: 47.46 pC - Rise Time: 0.88 ns

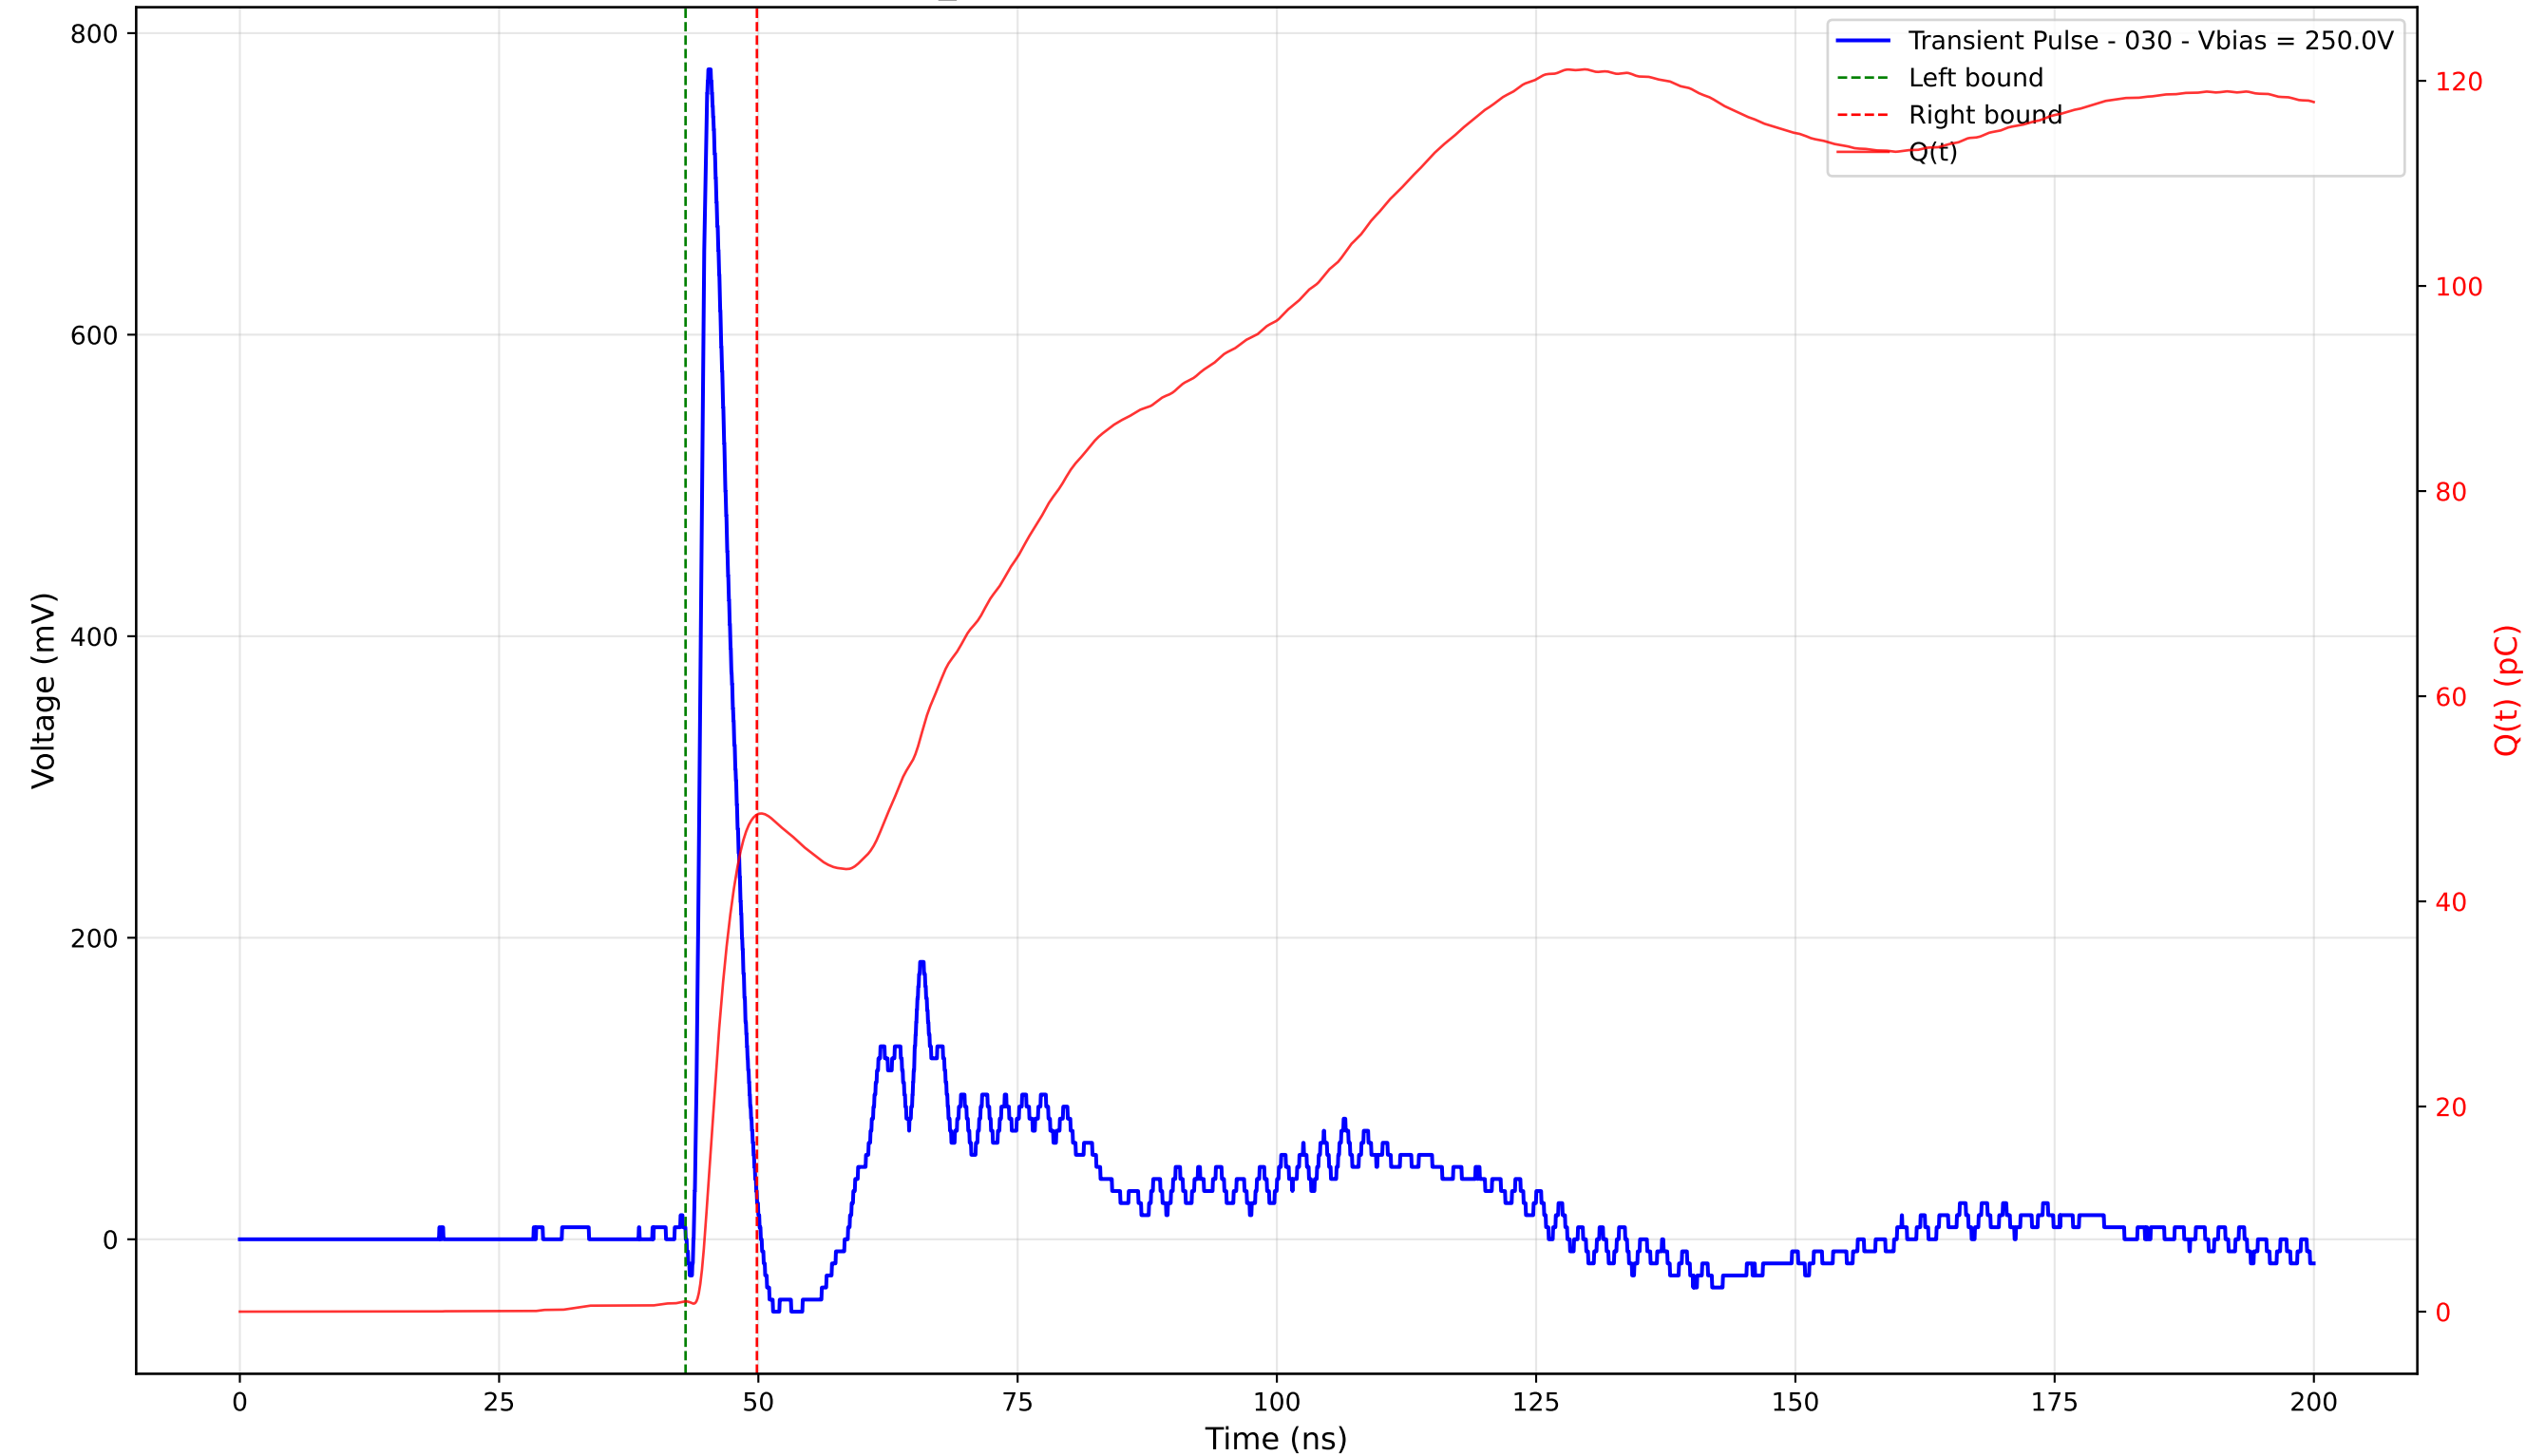


Transient Pulse - Sample: TD_4004 - Position: 125.0 μm - Charge: 47.01 pC - Rise Time: 0.90 ns

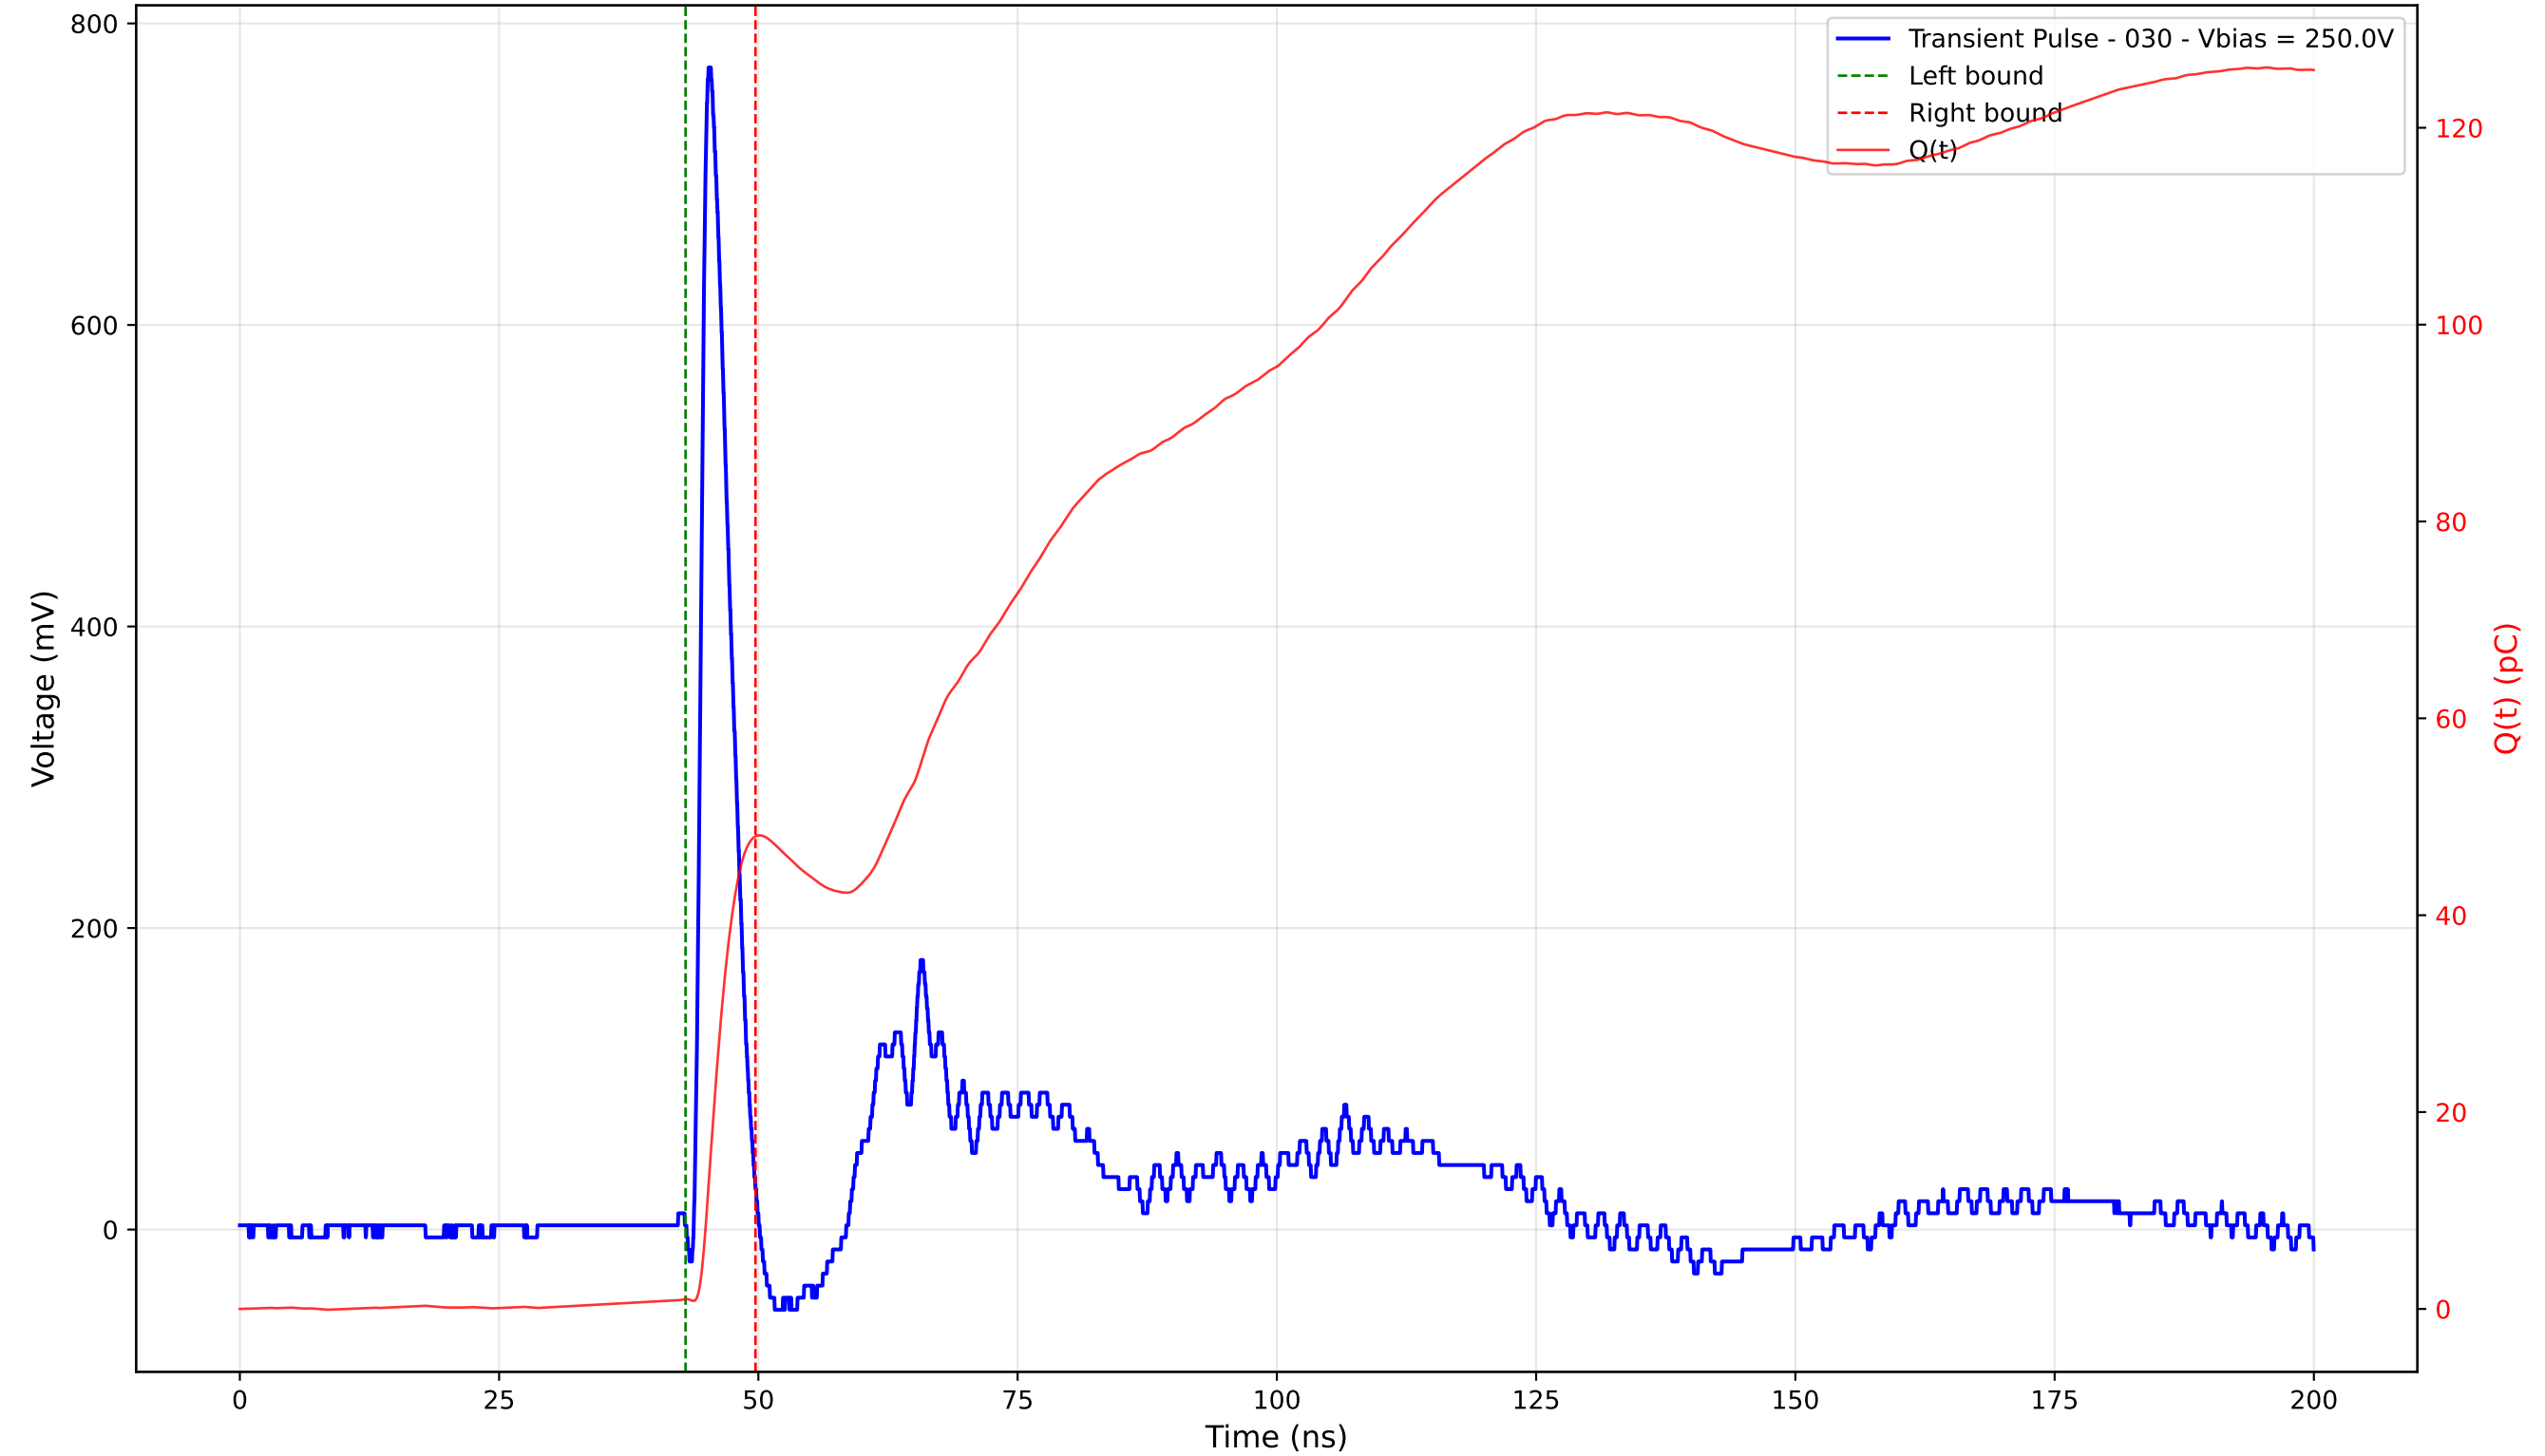


Transient Pulse - Sample: TD_4004 - Position: 130.0 μm - Charge: 46.02 pC - Rise Time: 0.90 ns

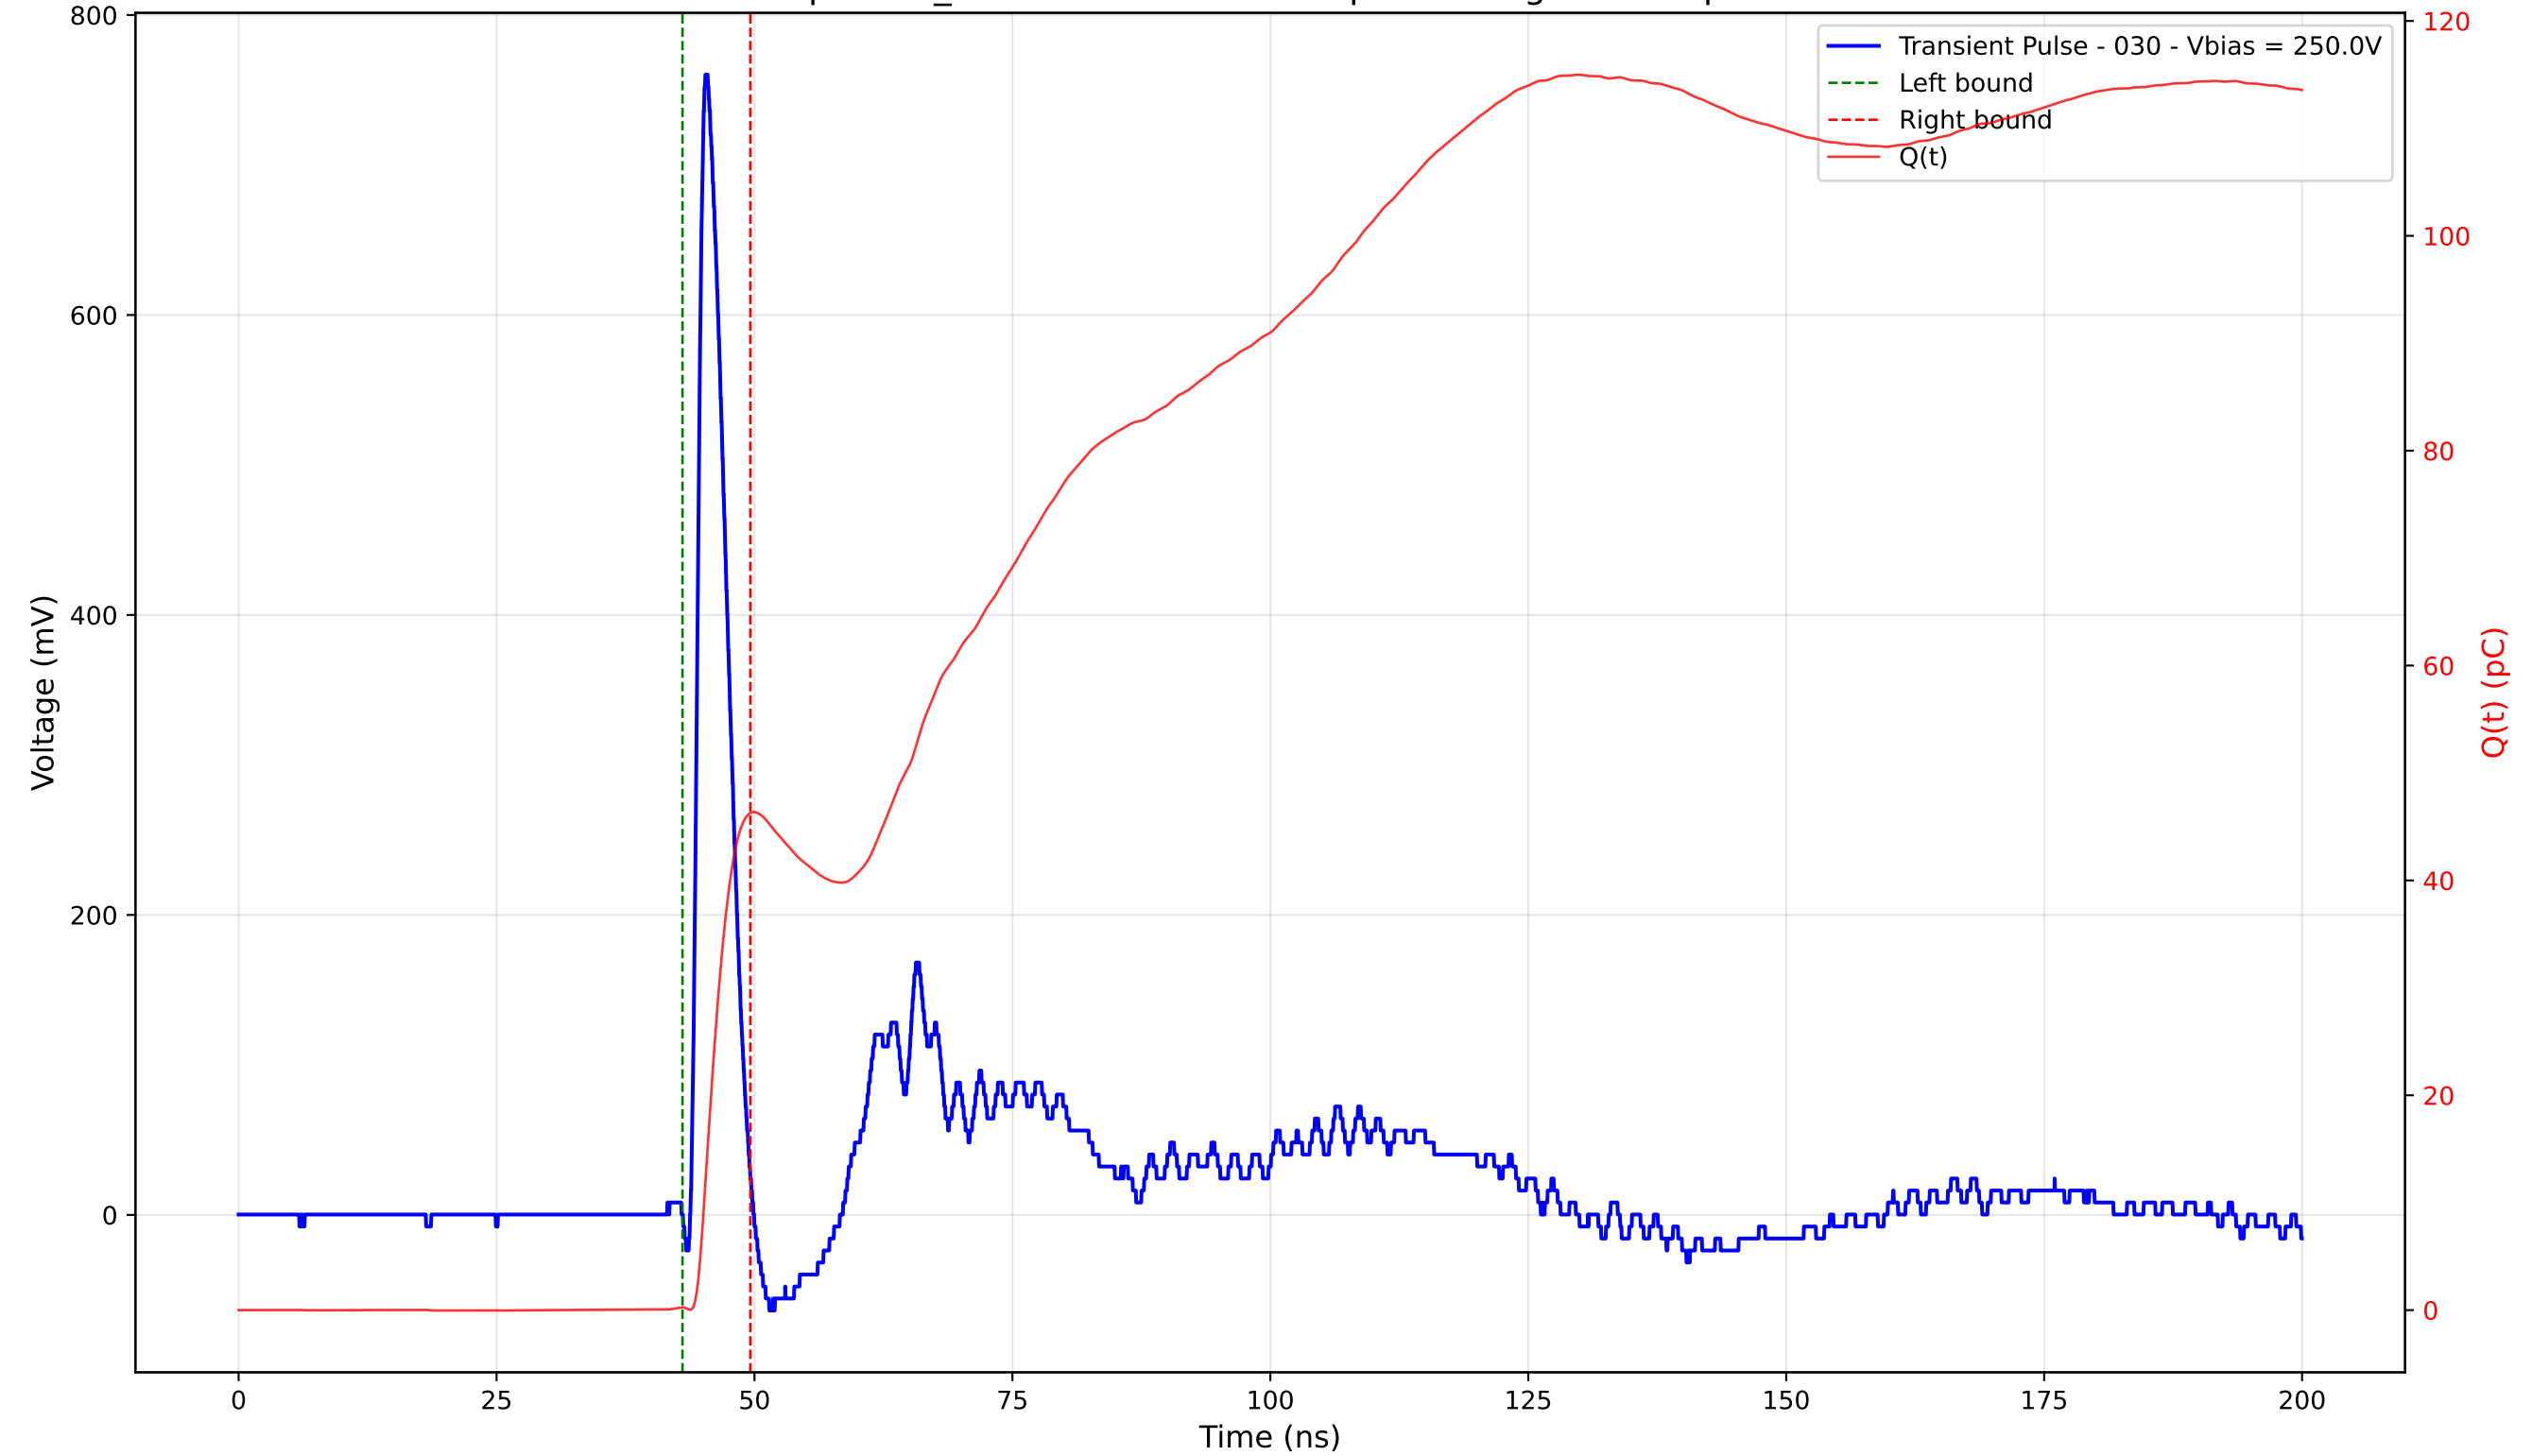


Transient Pulse - Sample: TD_4004 - Position: 135.0 μm - Charge: 45.86 pC - Rise Time: 0.91 ns

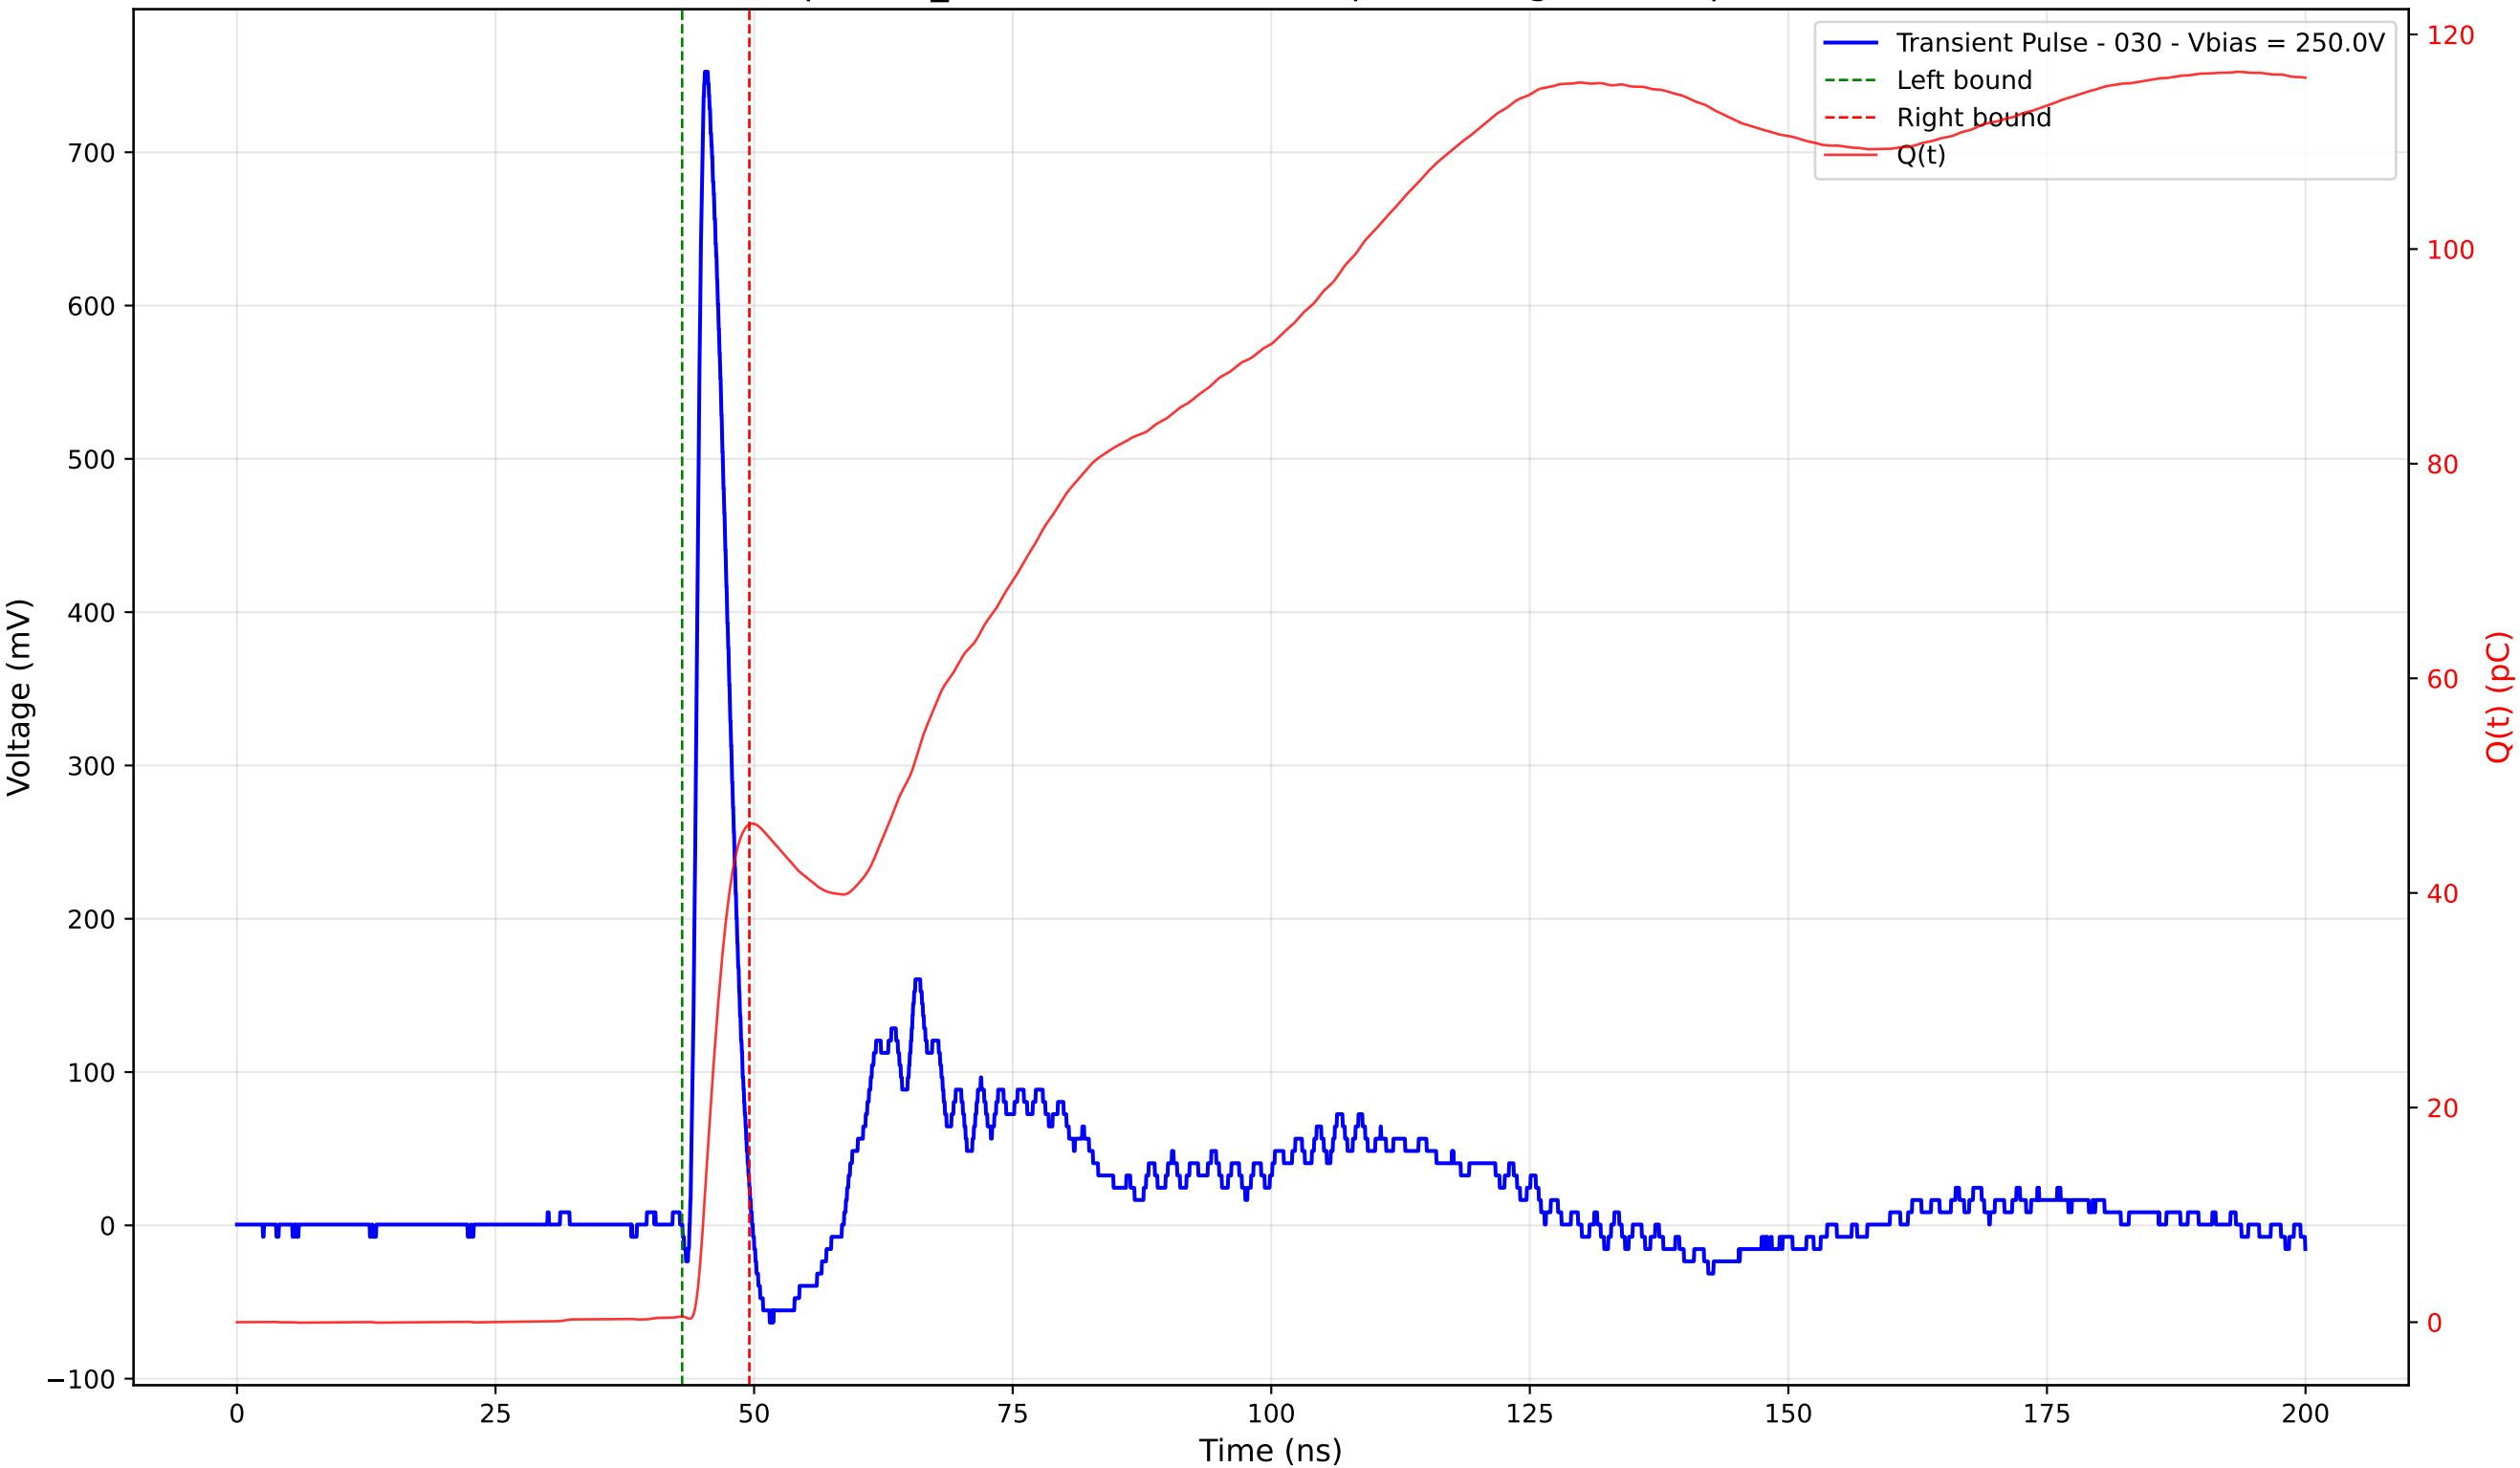


Transient Pulse - Sample: TD_4004 - Position: 140.0 μm - Charge: 45.77 pC - Rise Time: 0.93 ns

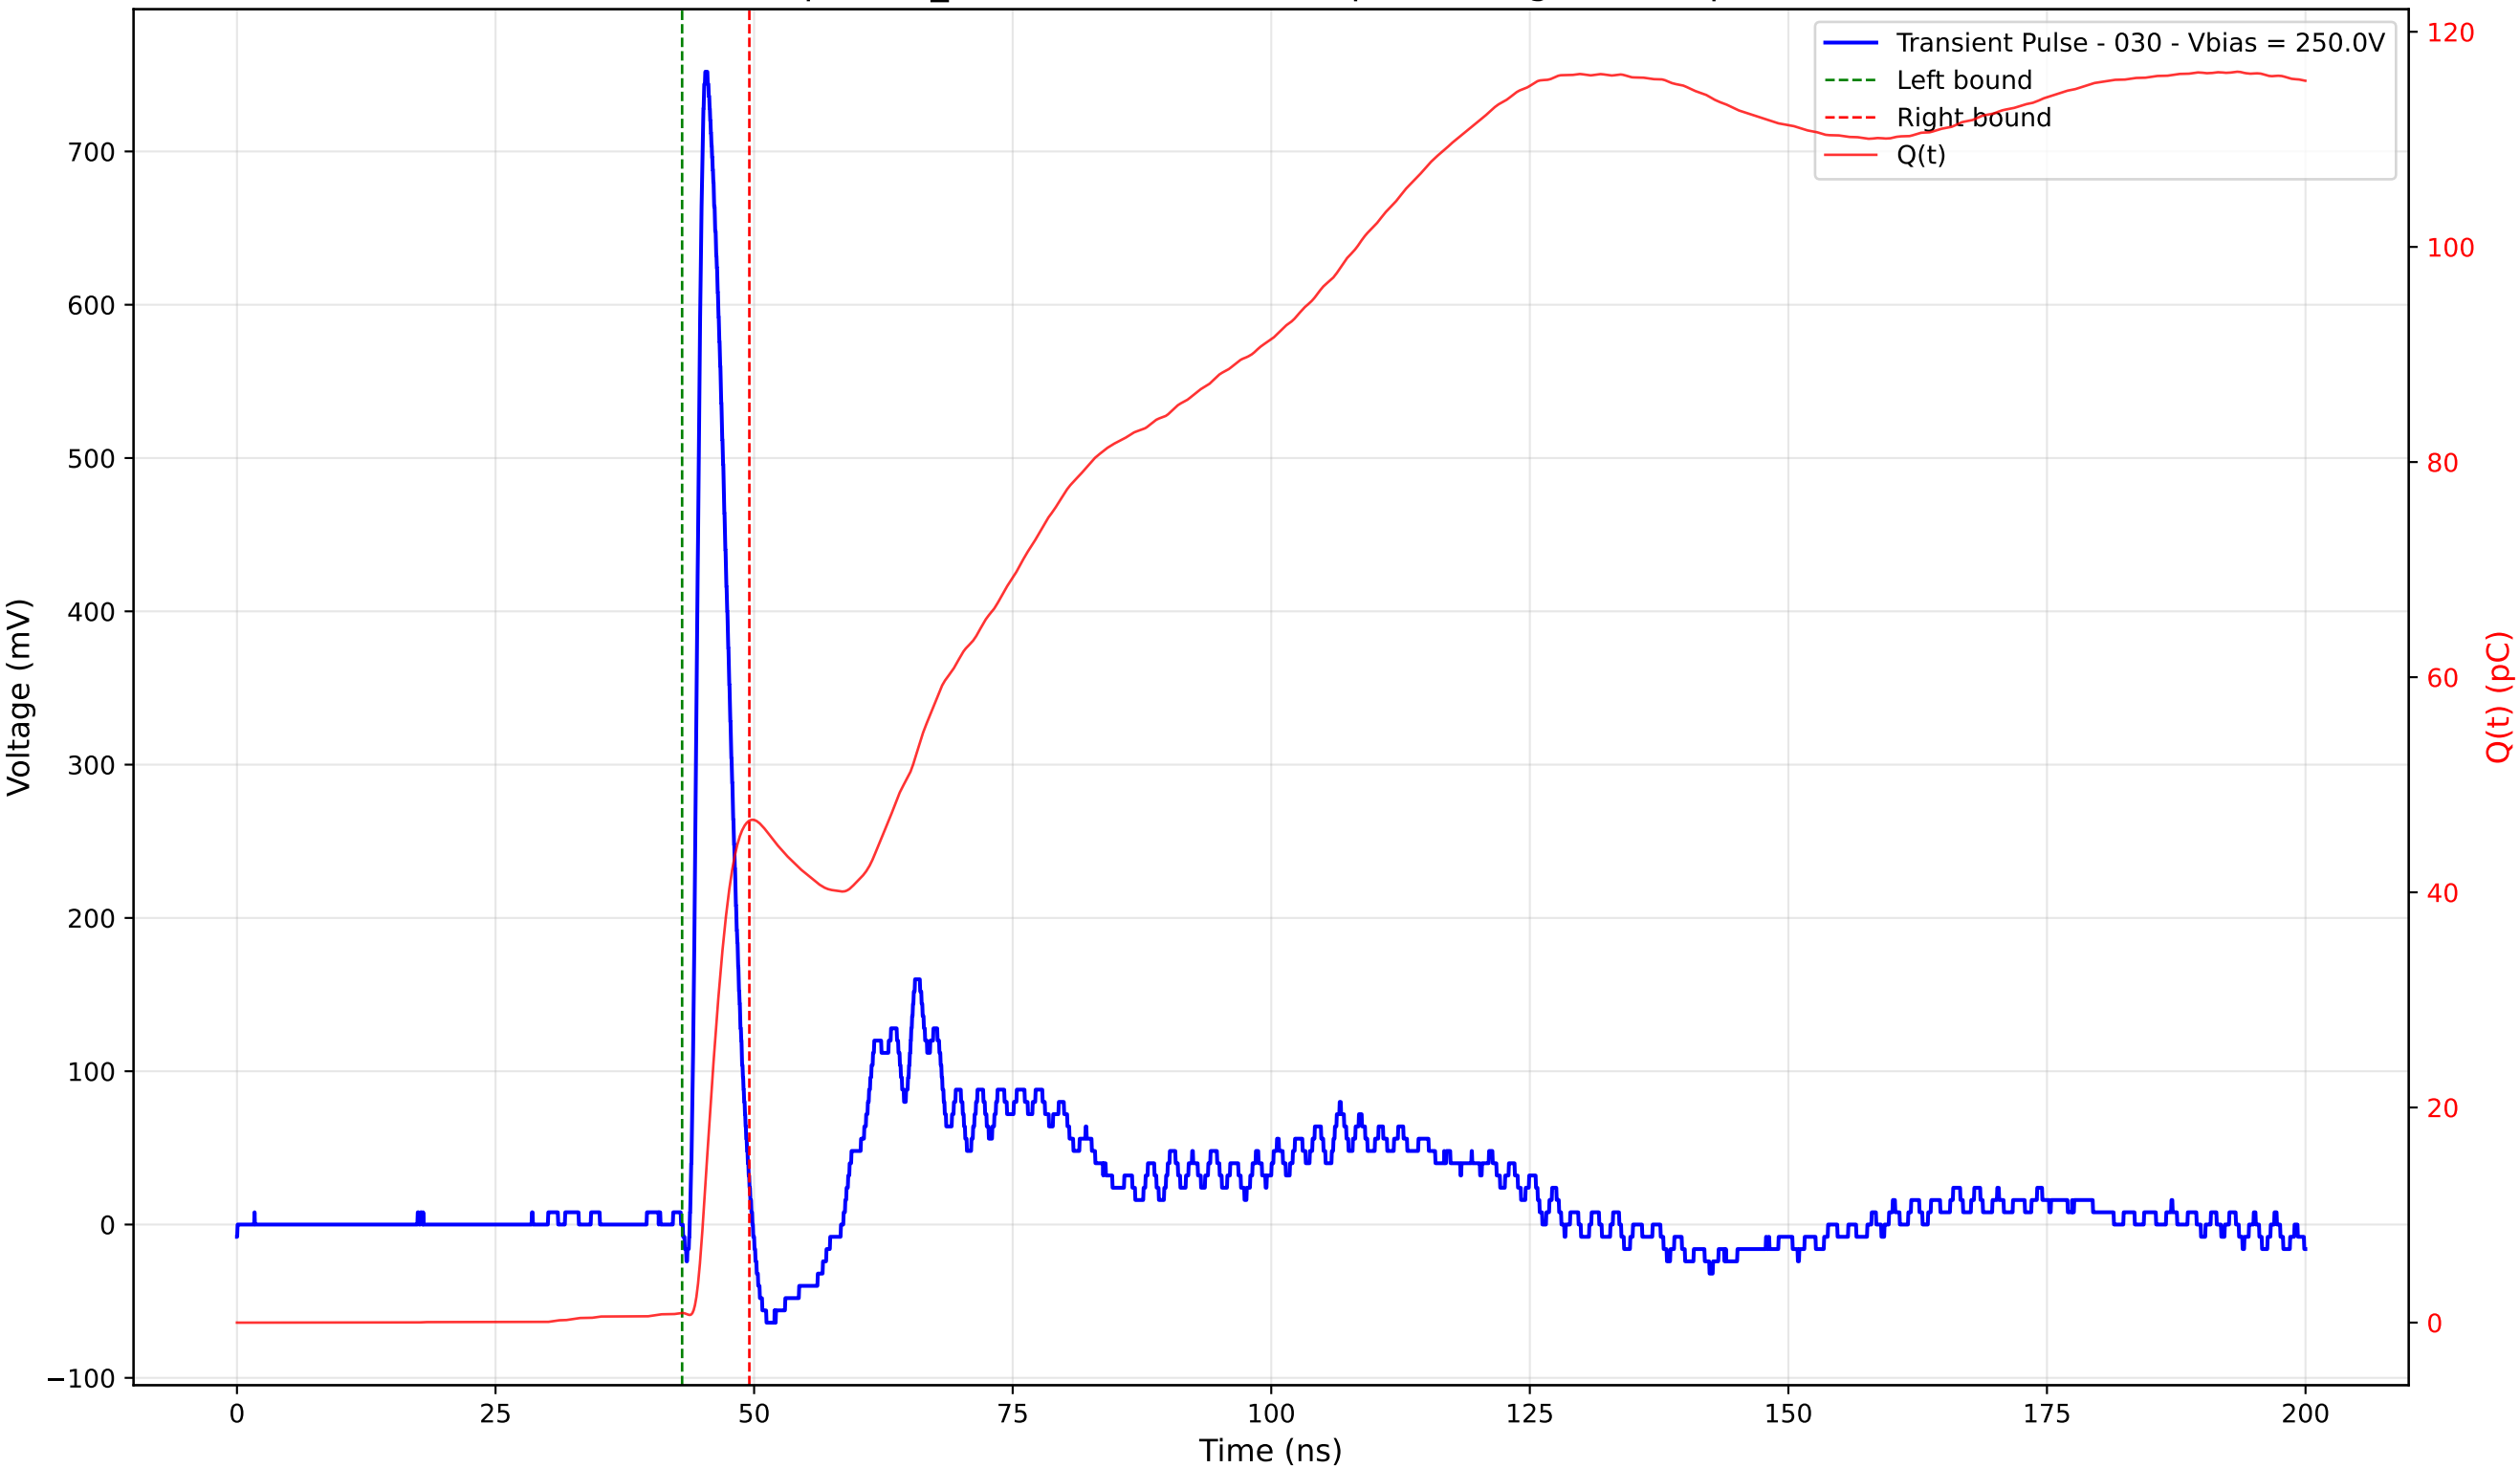


Transient Pulse - Sample: TD_4004 - Position: 145.0 μm - Charge: 45.66 pC - Rise Time: 0.93 ns

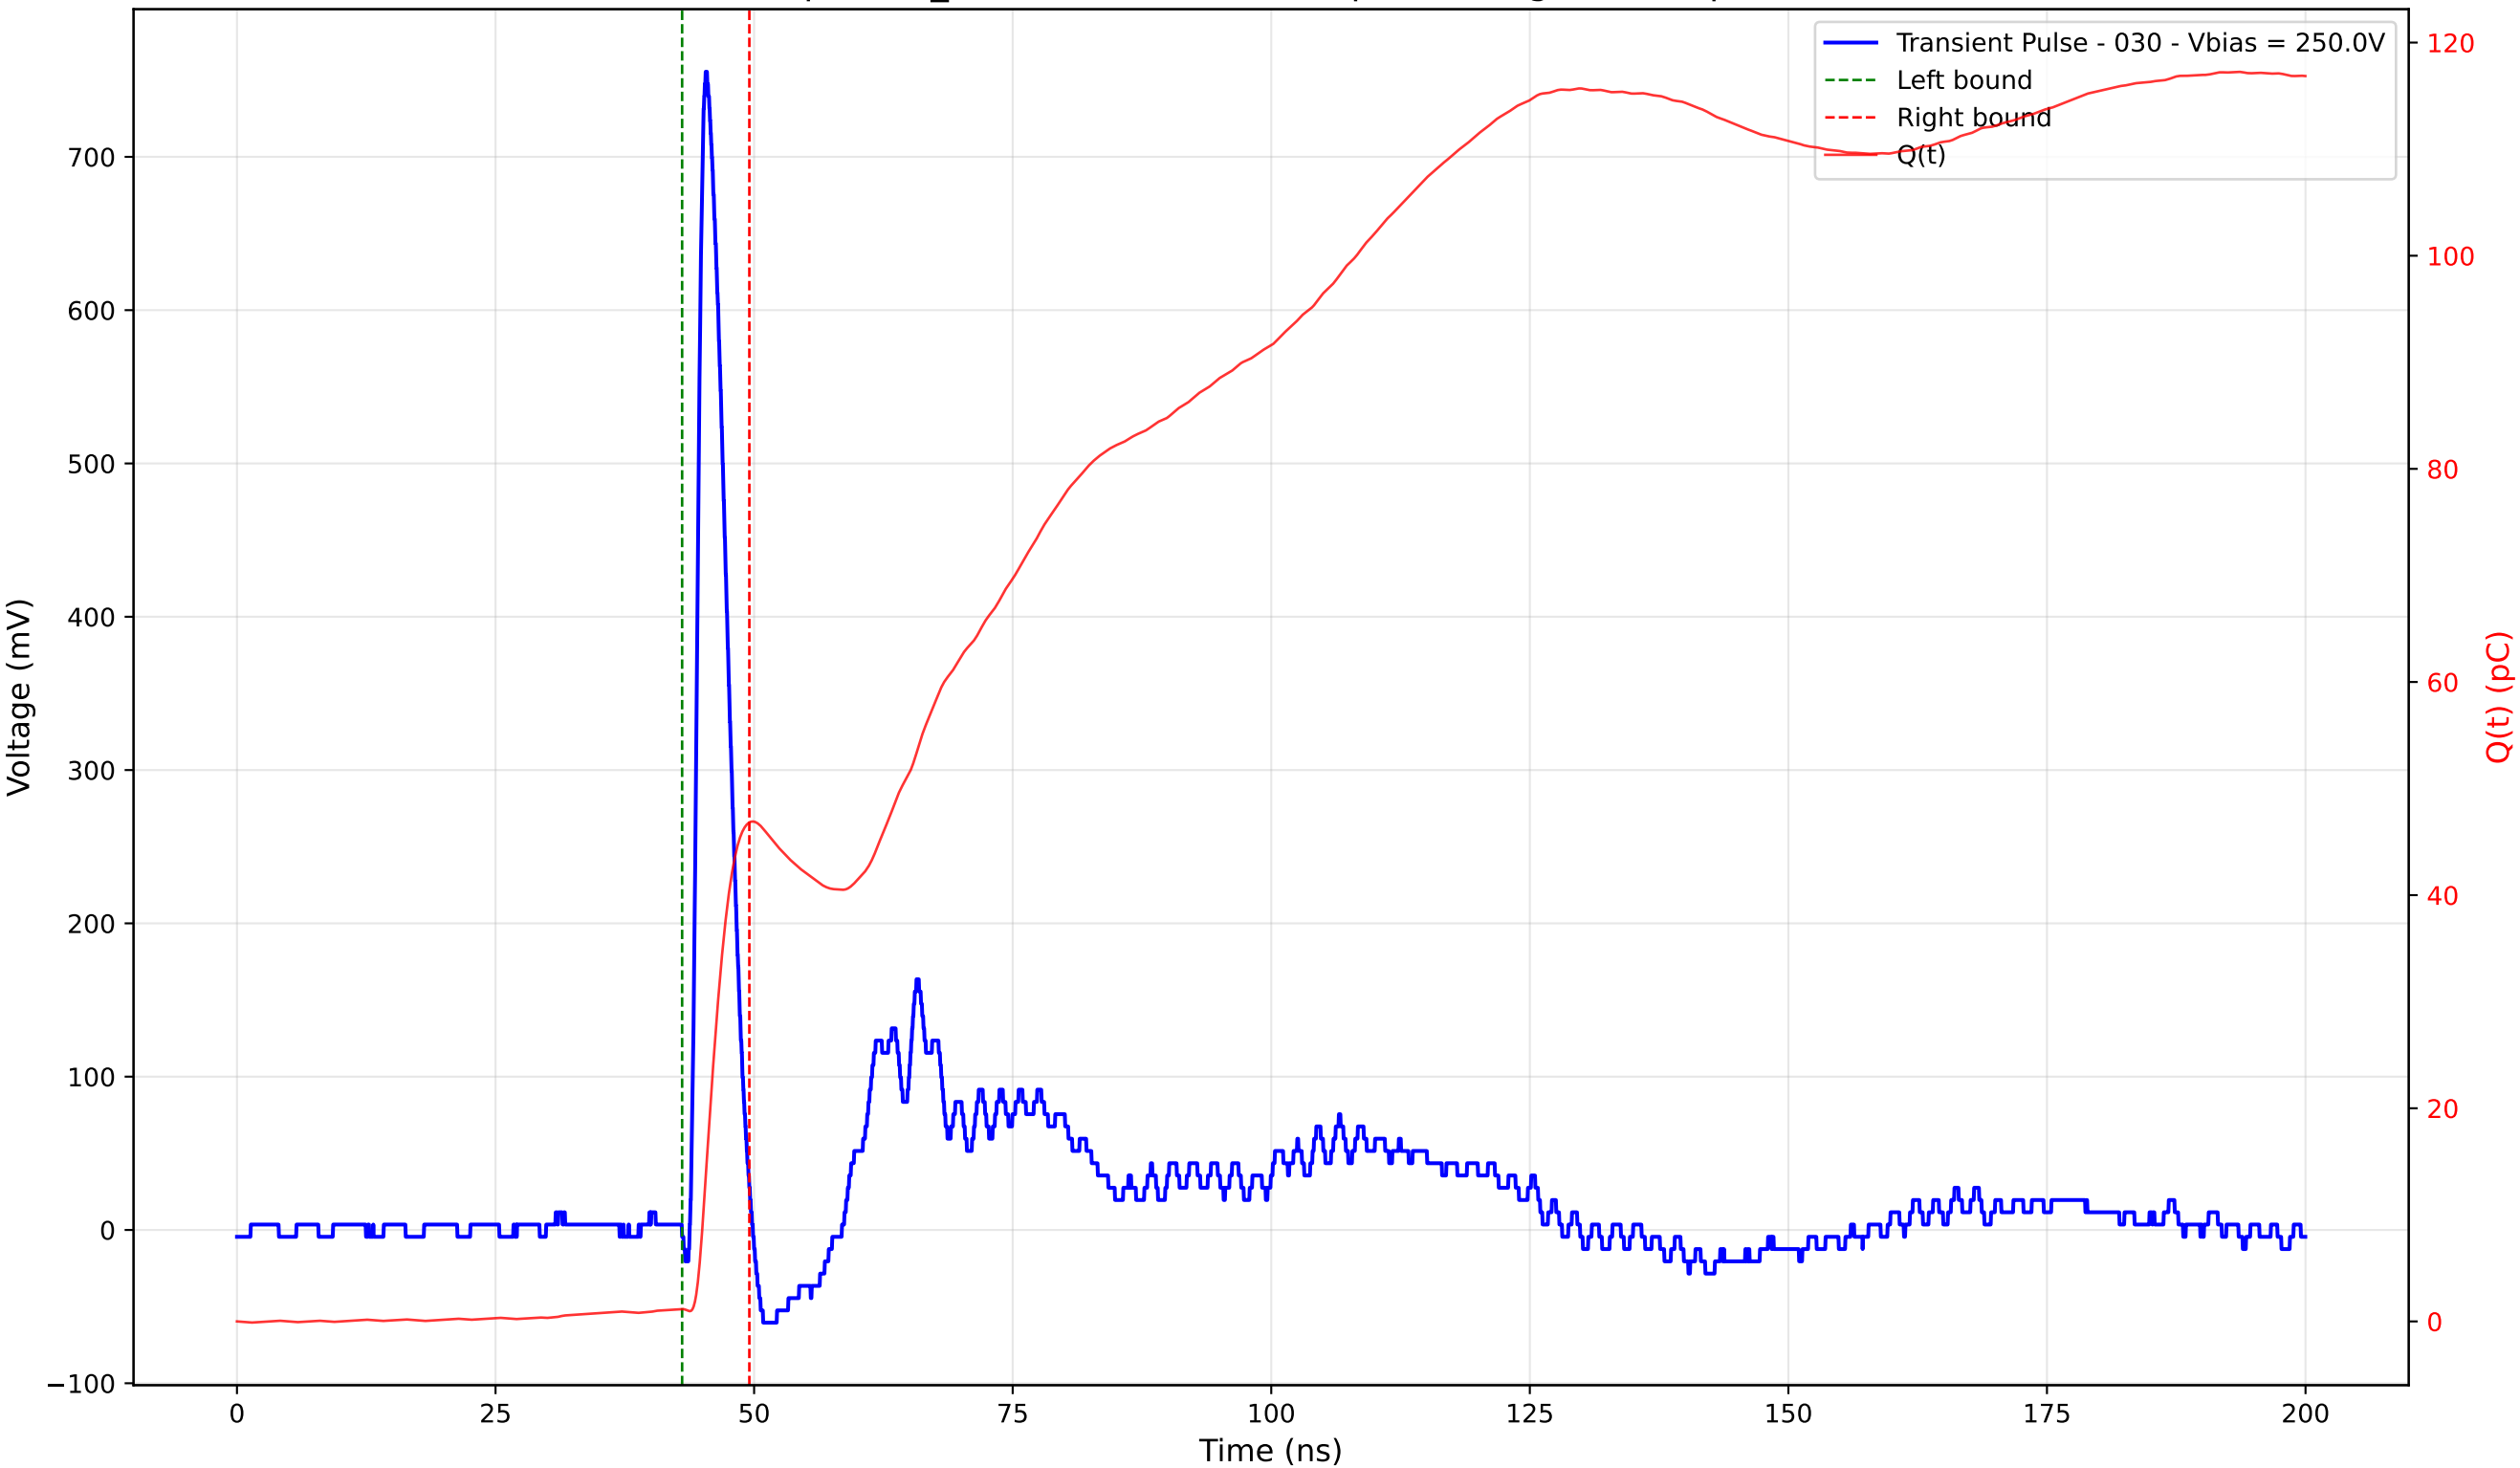


Transient Pulse - Sample: TD_4004 - Position: 150.0 μm - Charge: 45.45 pC - Rise Time: 0.92 ns

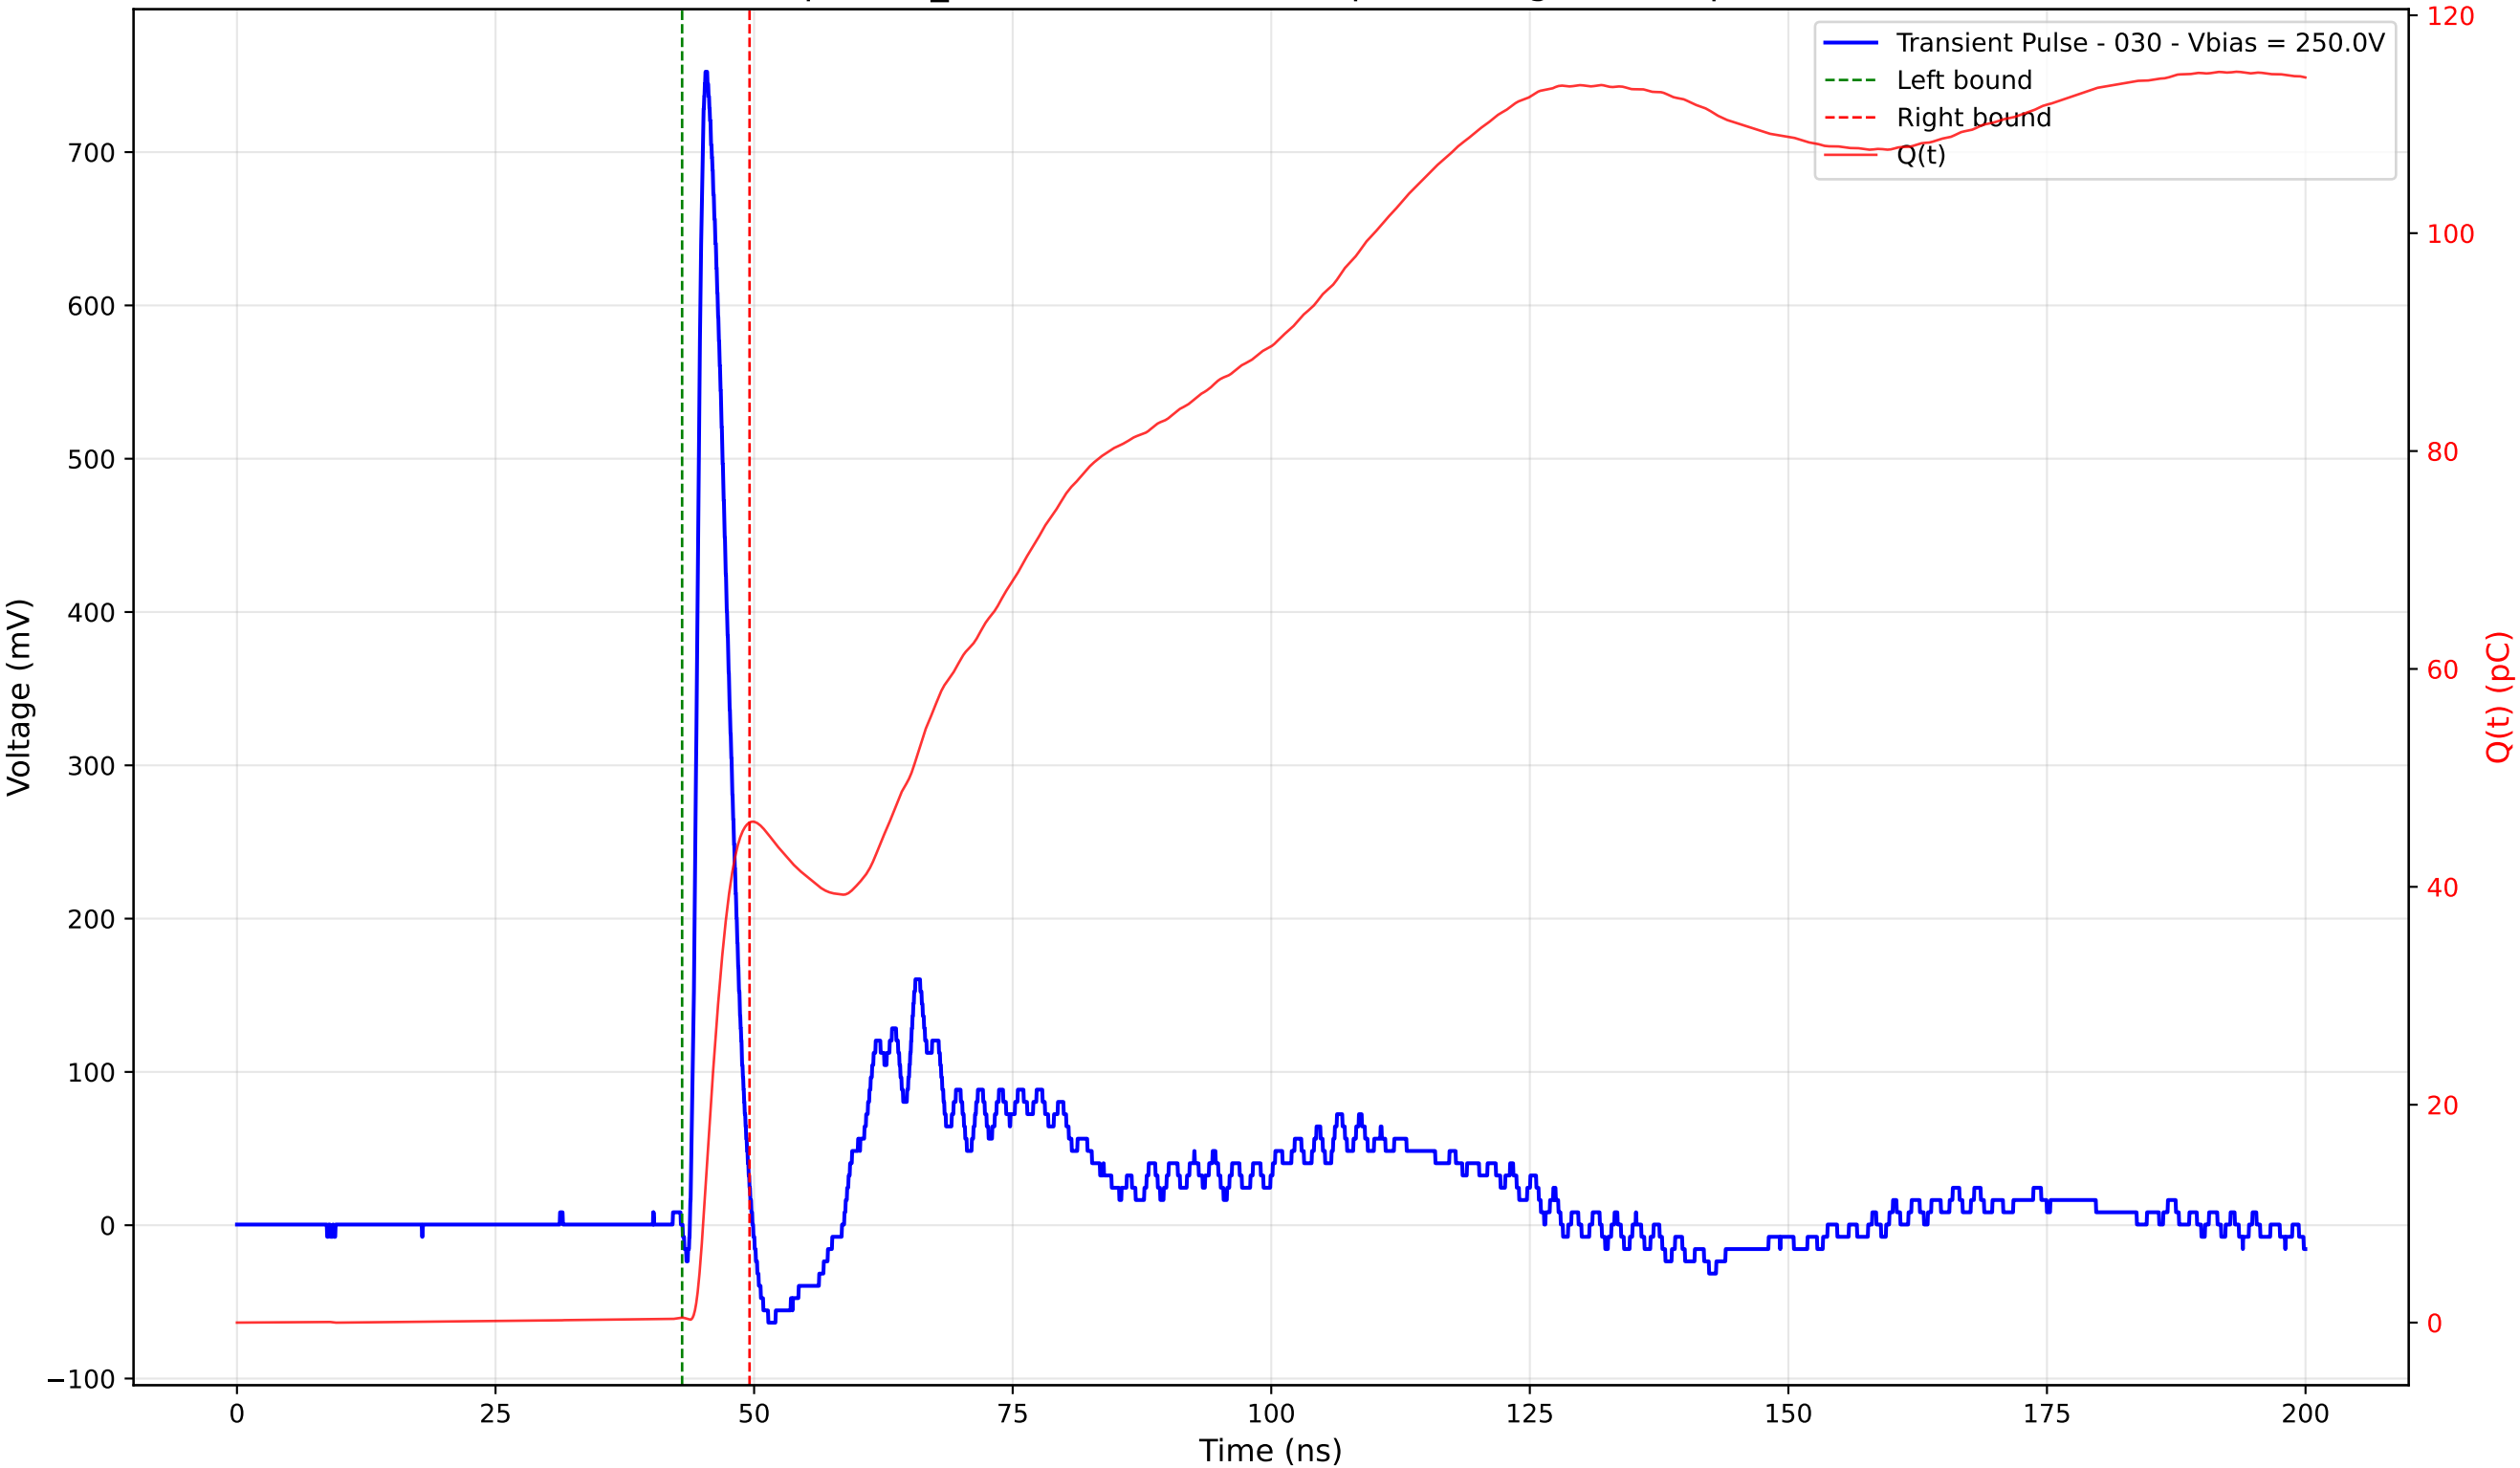


Transient Pulse - Sample: TD_4004 - Position: 155.0 μm - Charge: 45.92 pC - Rise Time: 0.93 ns

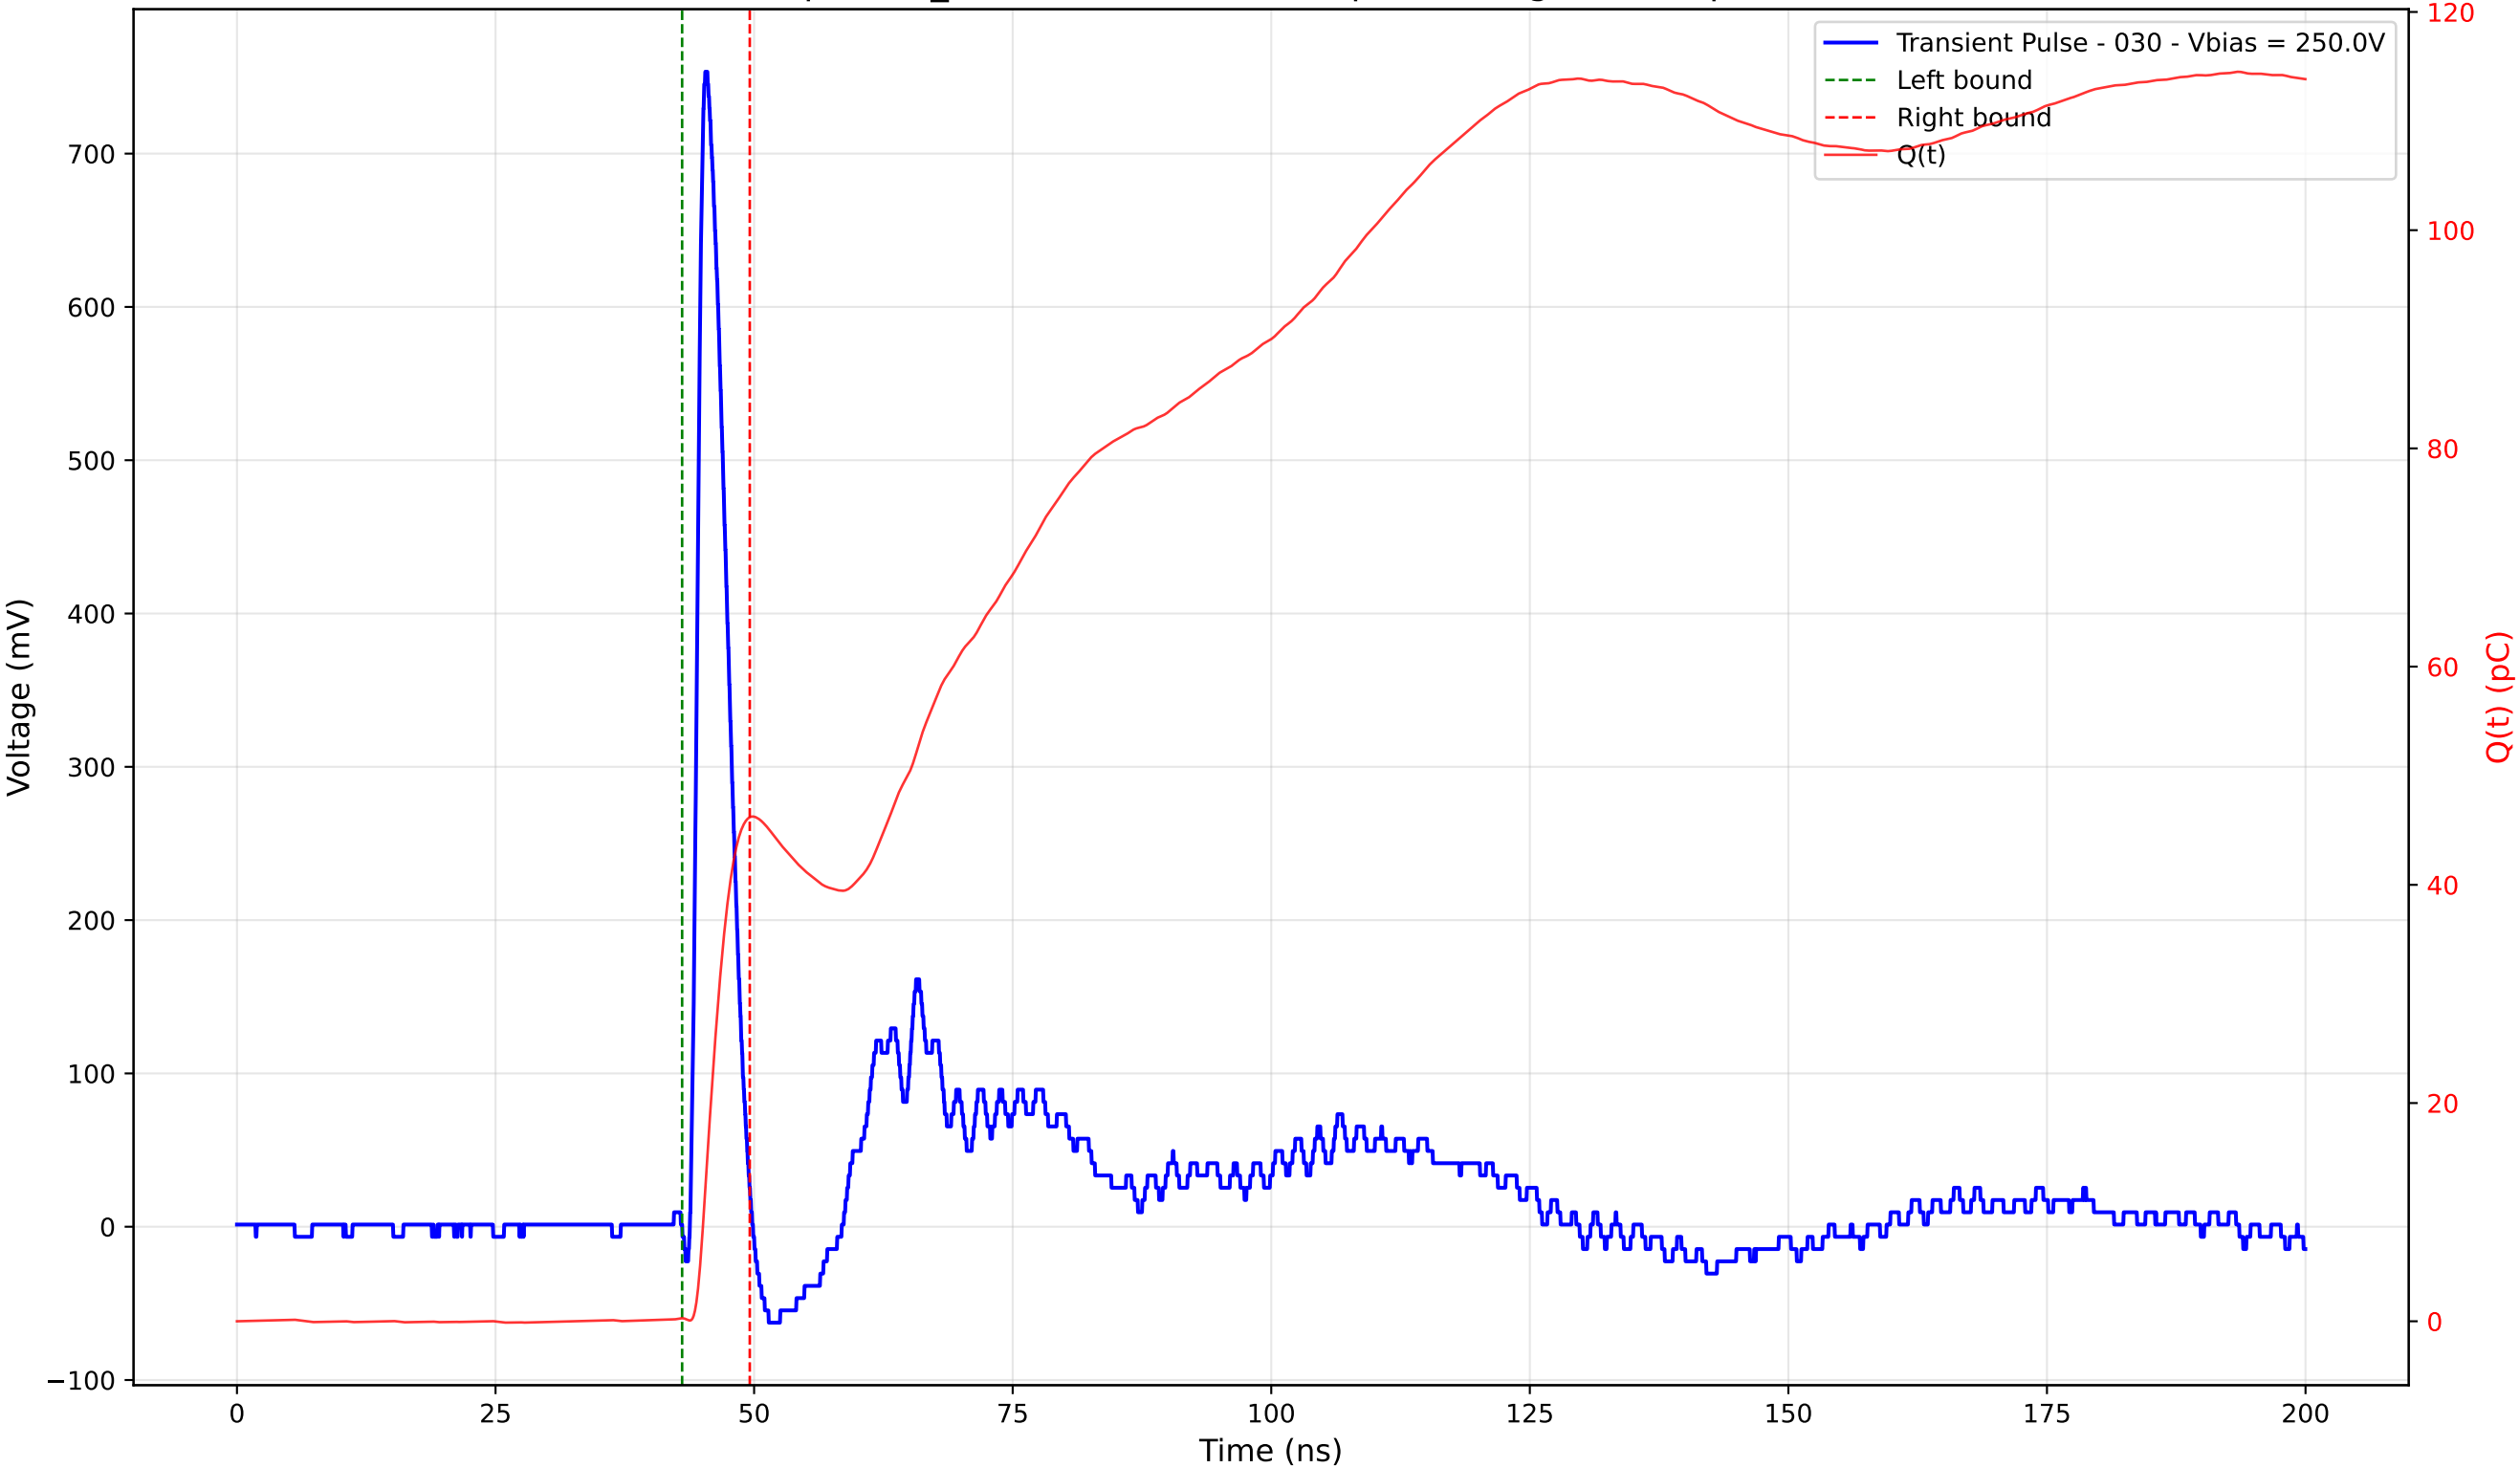


Transient Pulse - Sample: TD_4004 - Position: 160.0 μm - Charge: 46.62 pC - Rise Time: 0.93 ns

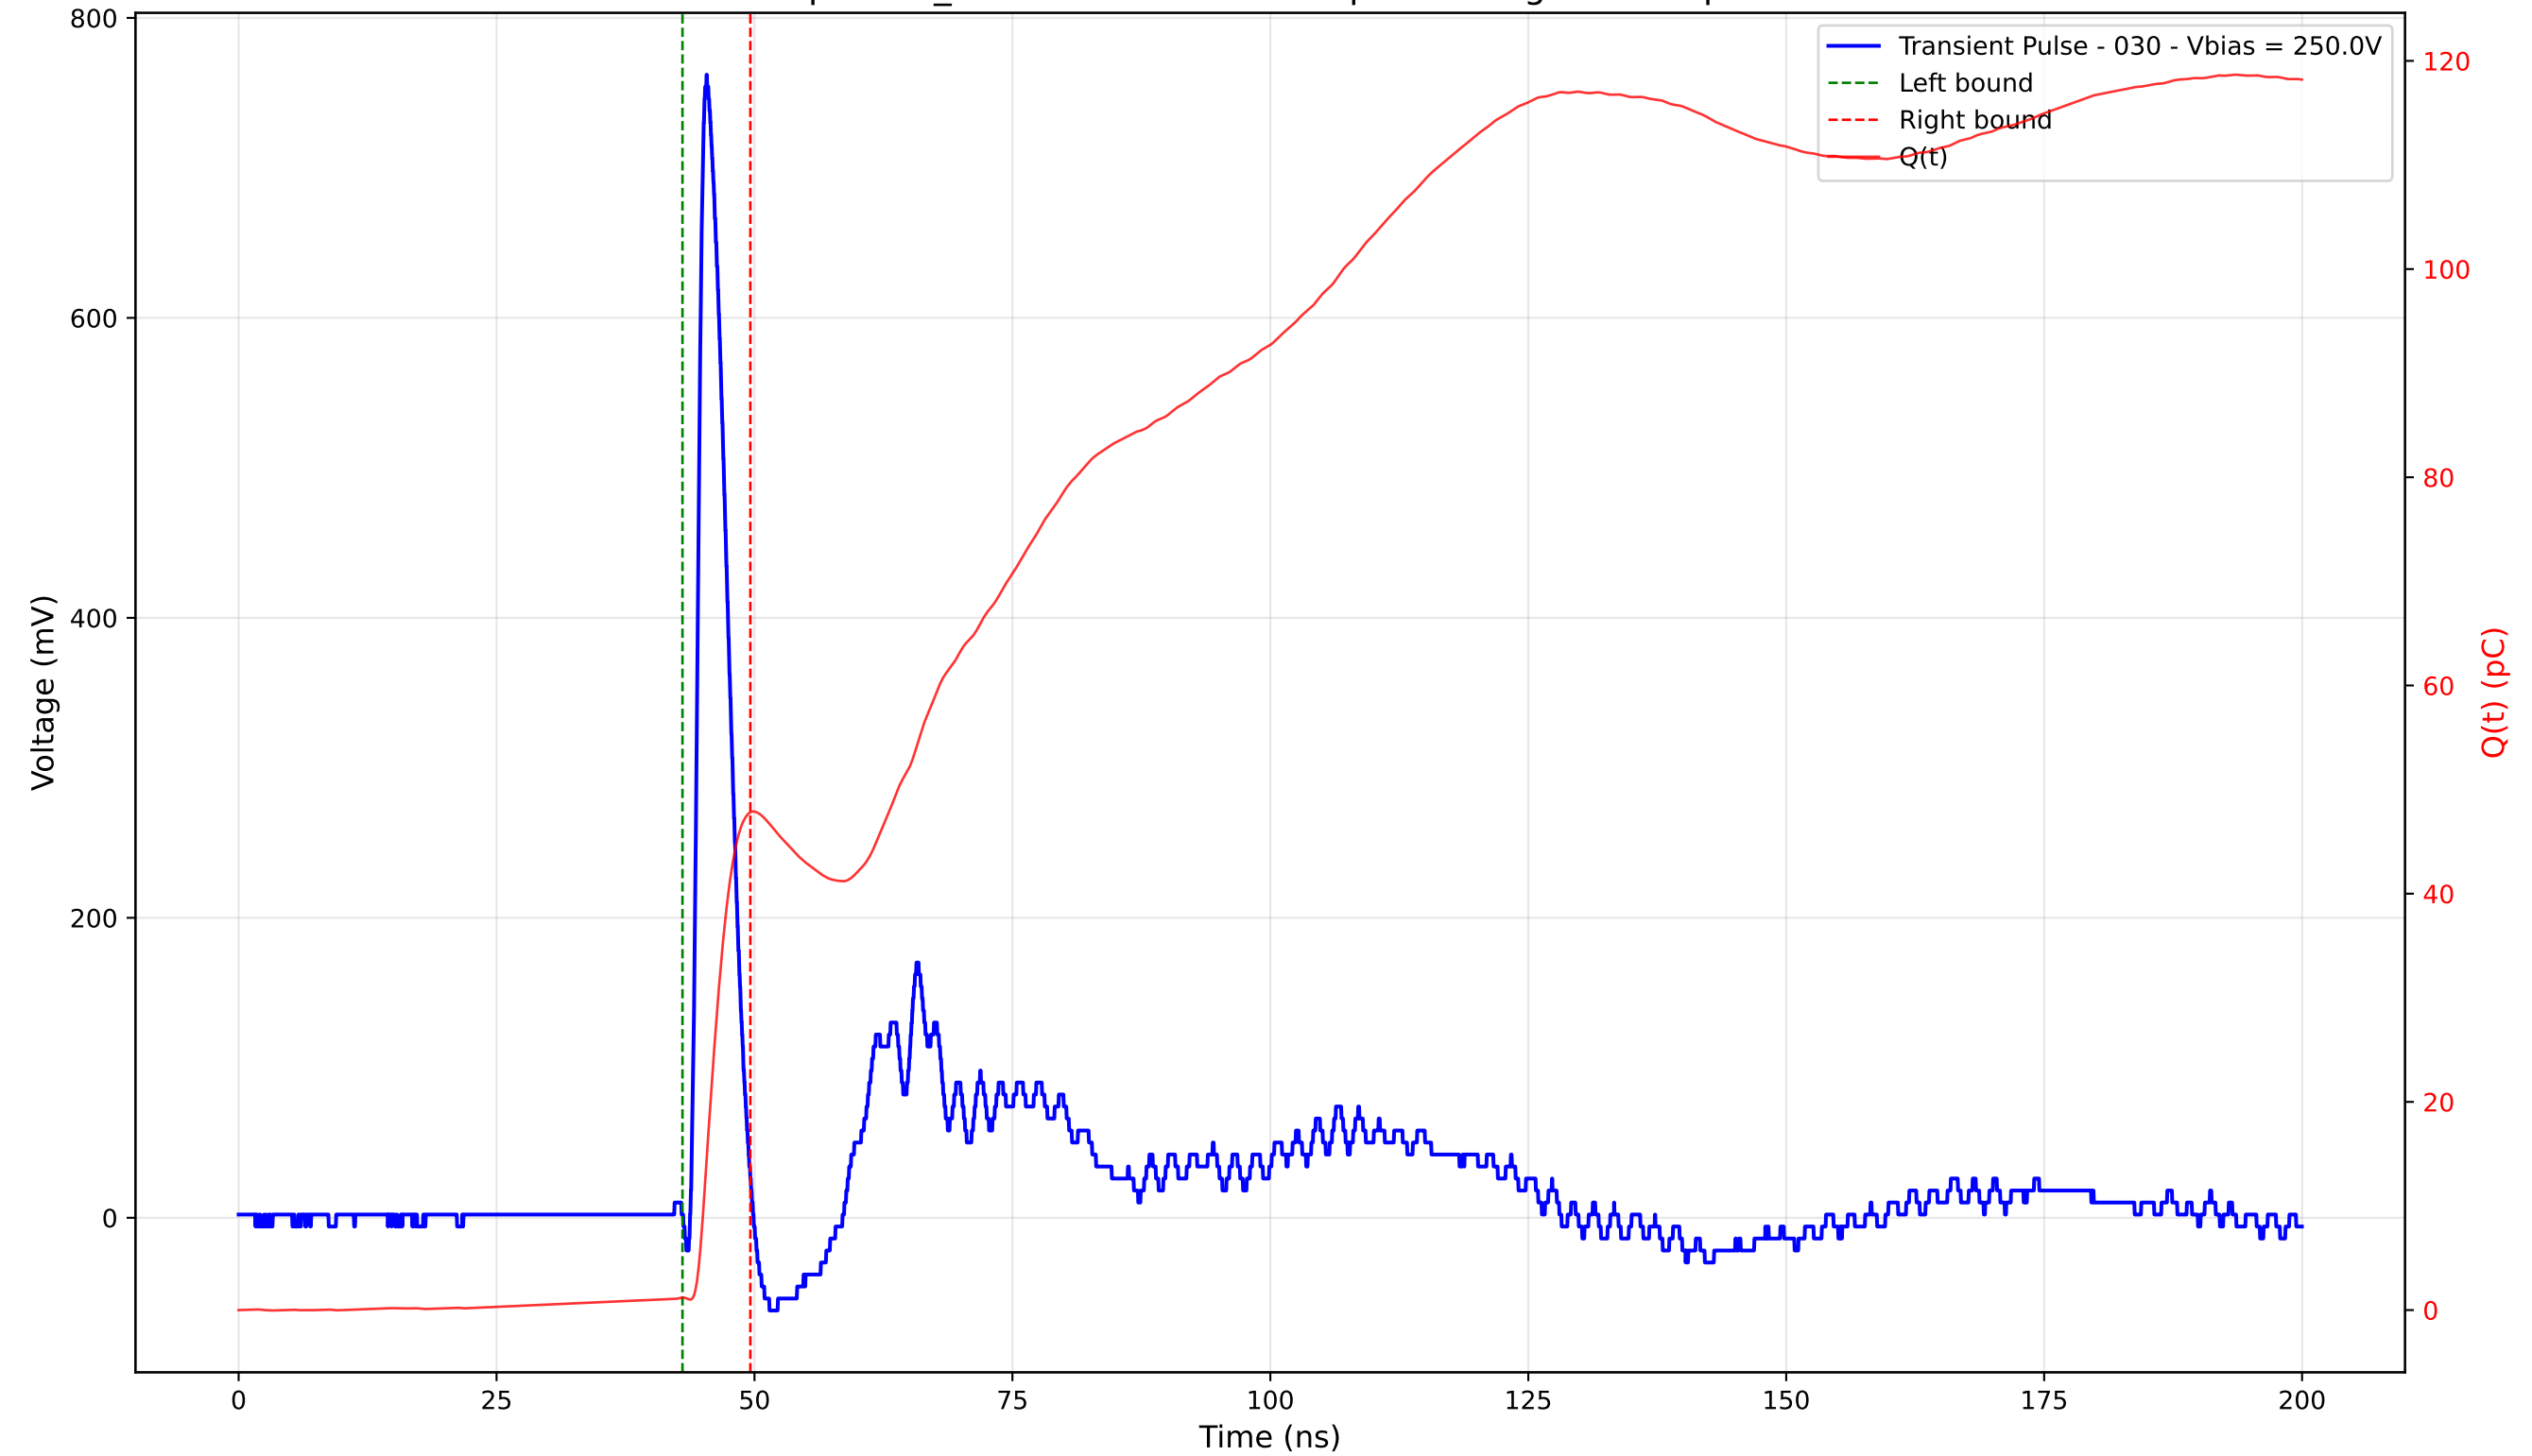


Transient Pulse - Sample: TD_4004 - Position: 165.0 μm - Charge: 47.66 pC - Rise Time: 0.92 ns

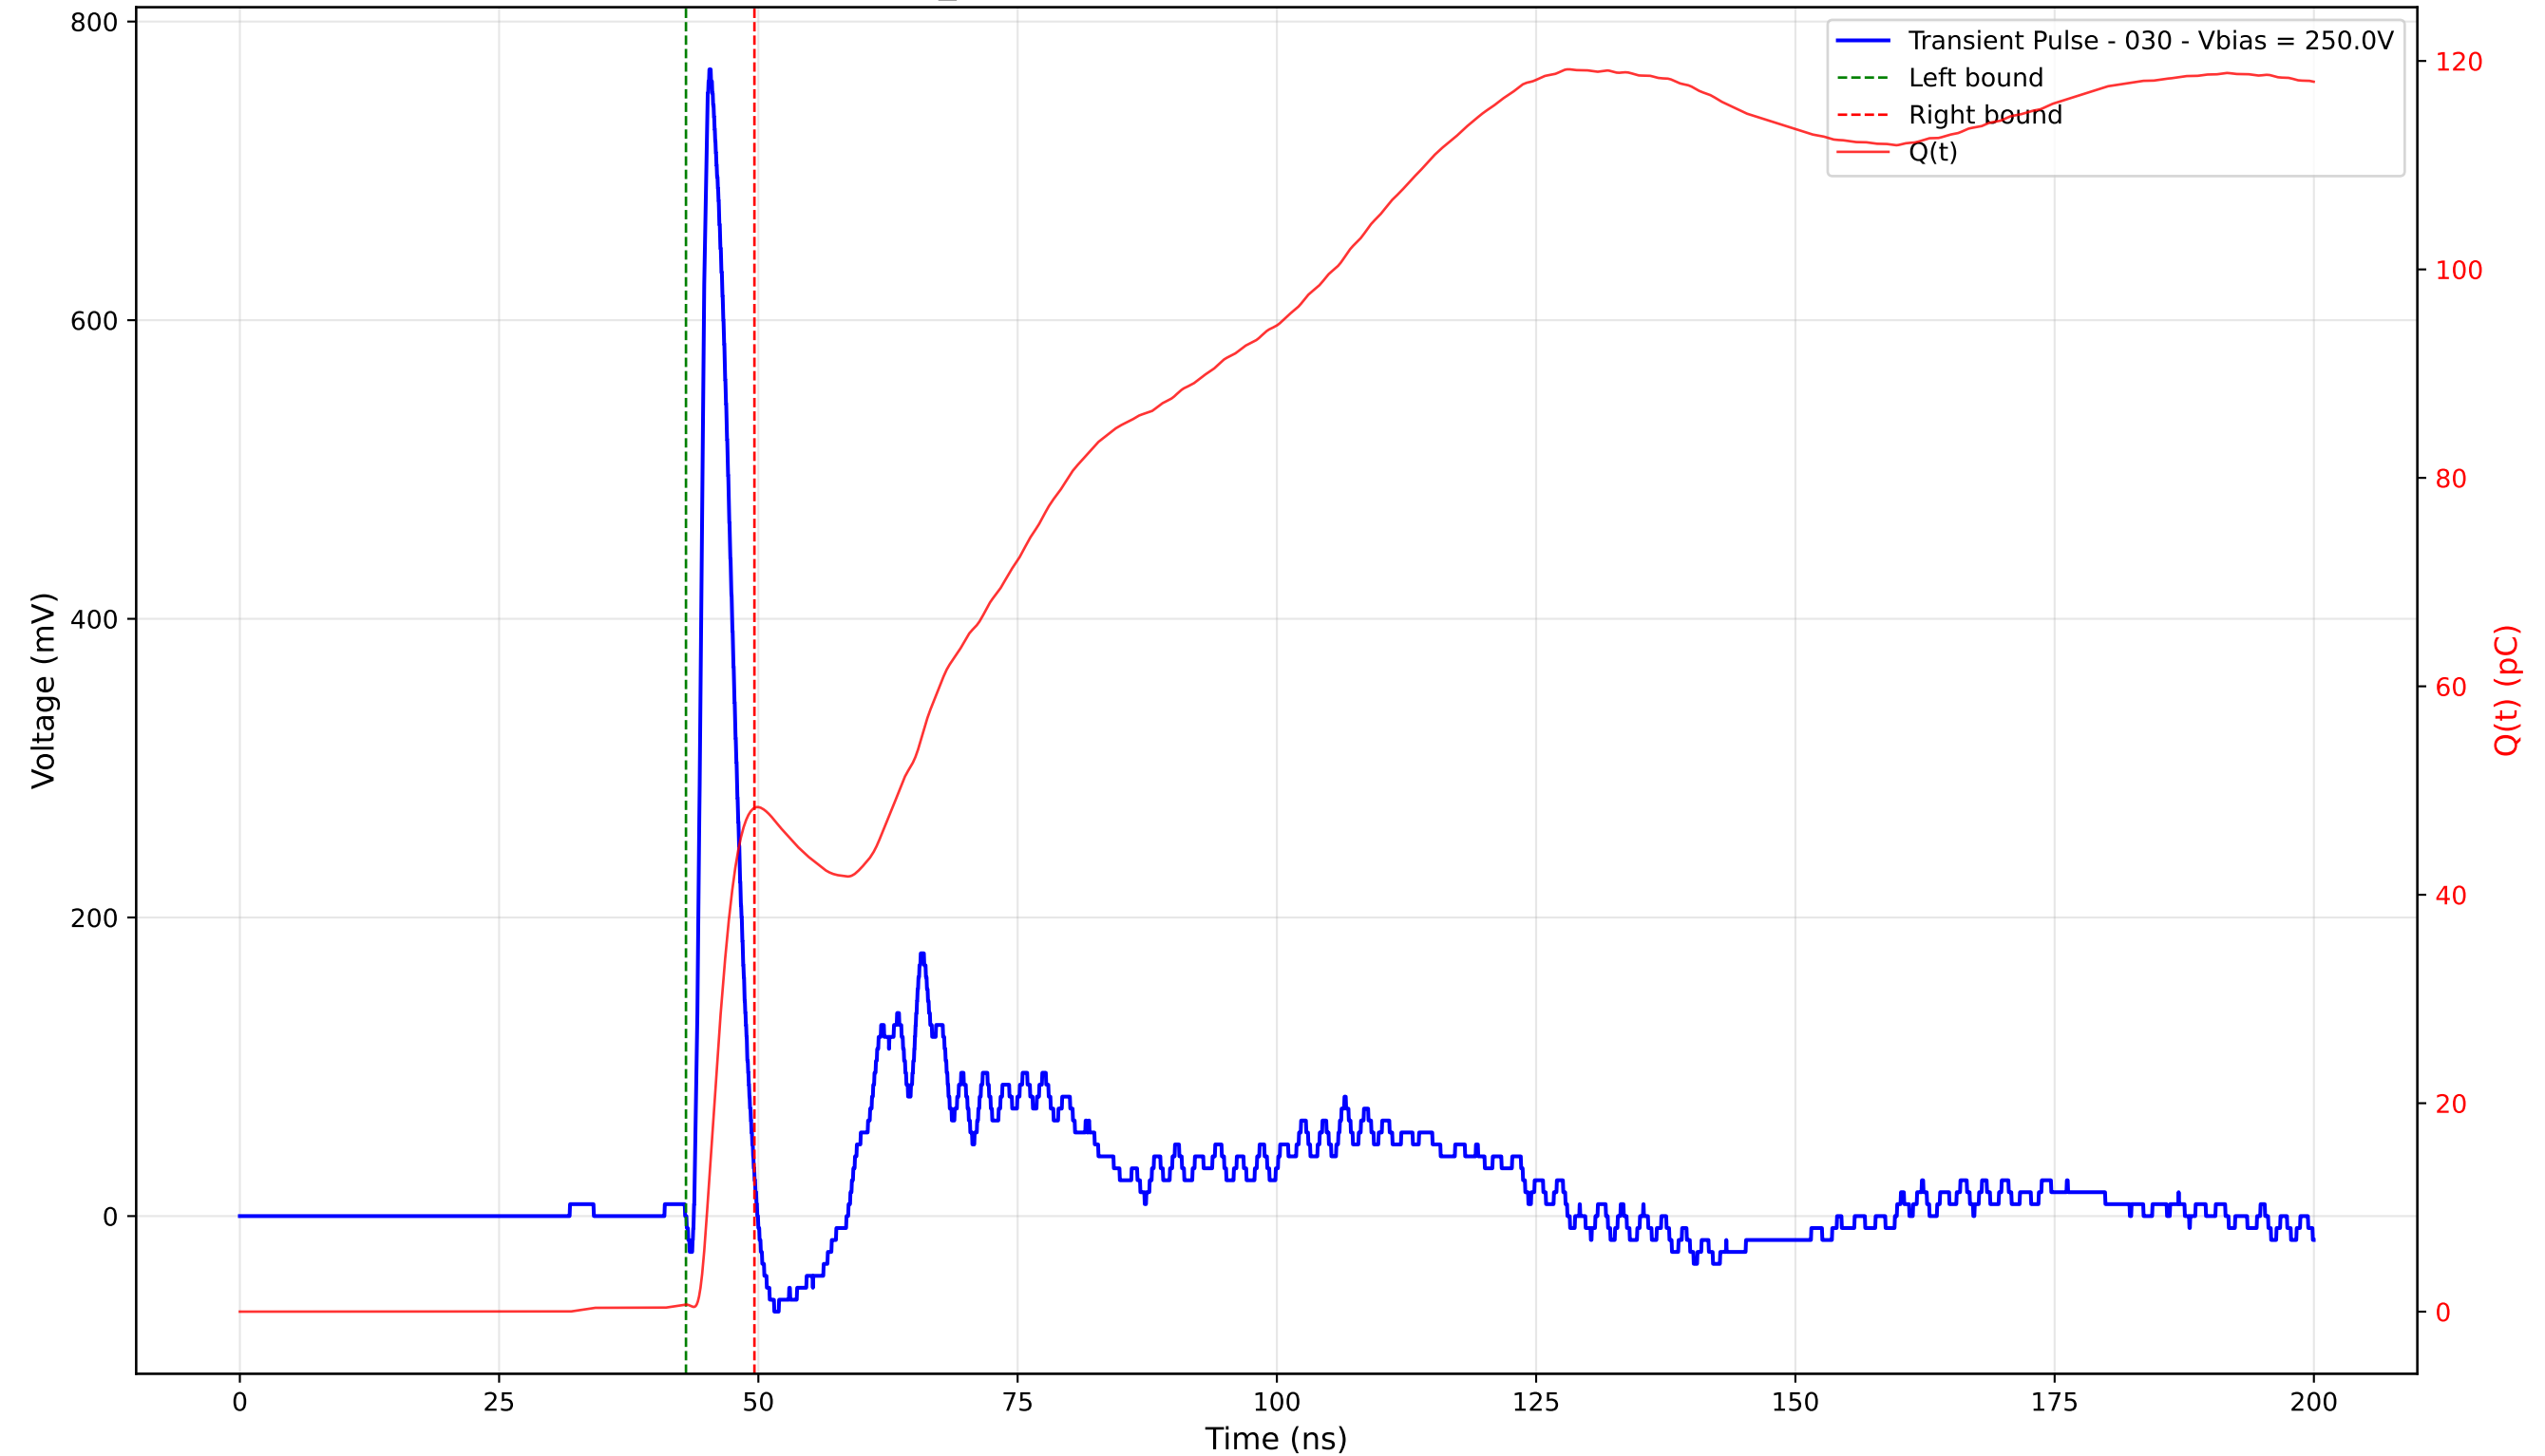


Transient Pulse - Sample: TD_4004 - Position: 170.0 μm - Charge: 48.29 pC - Rise Time: 0.91 ns

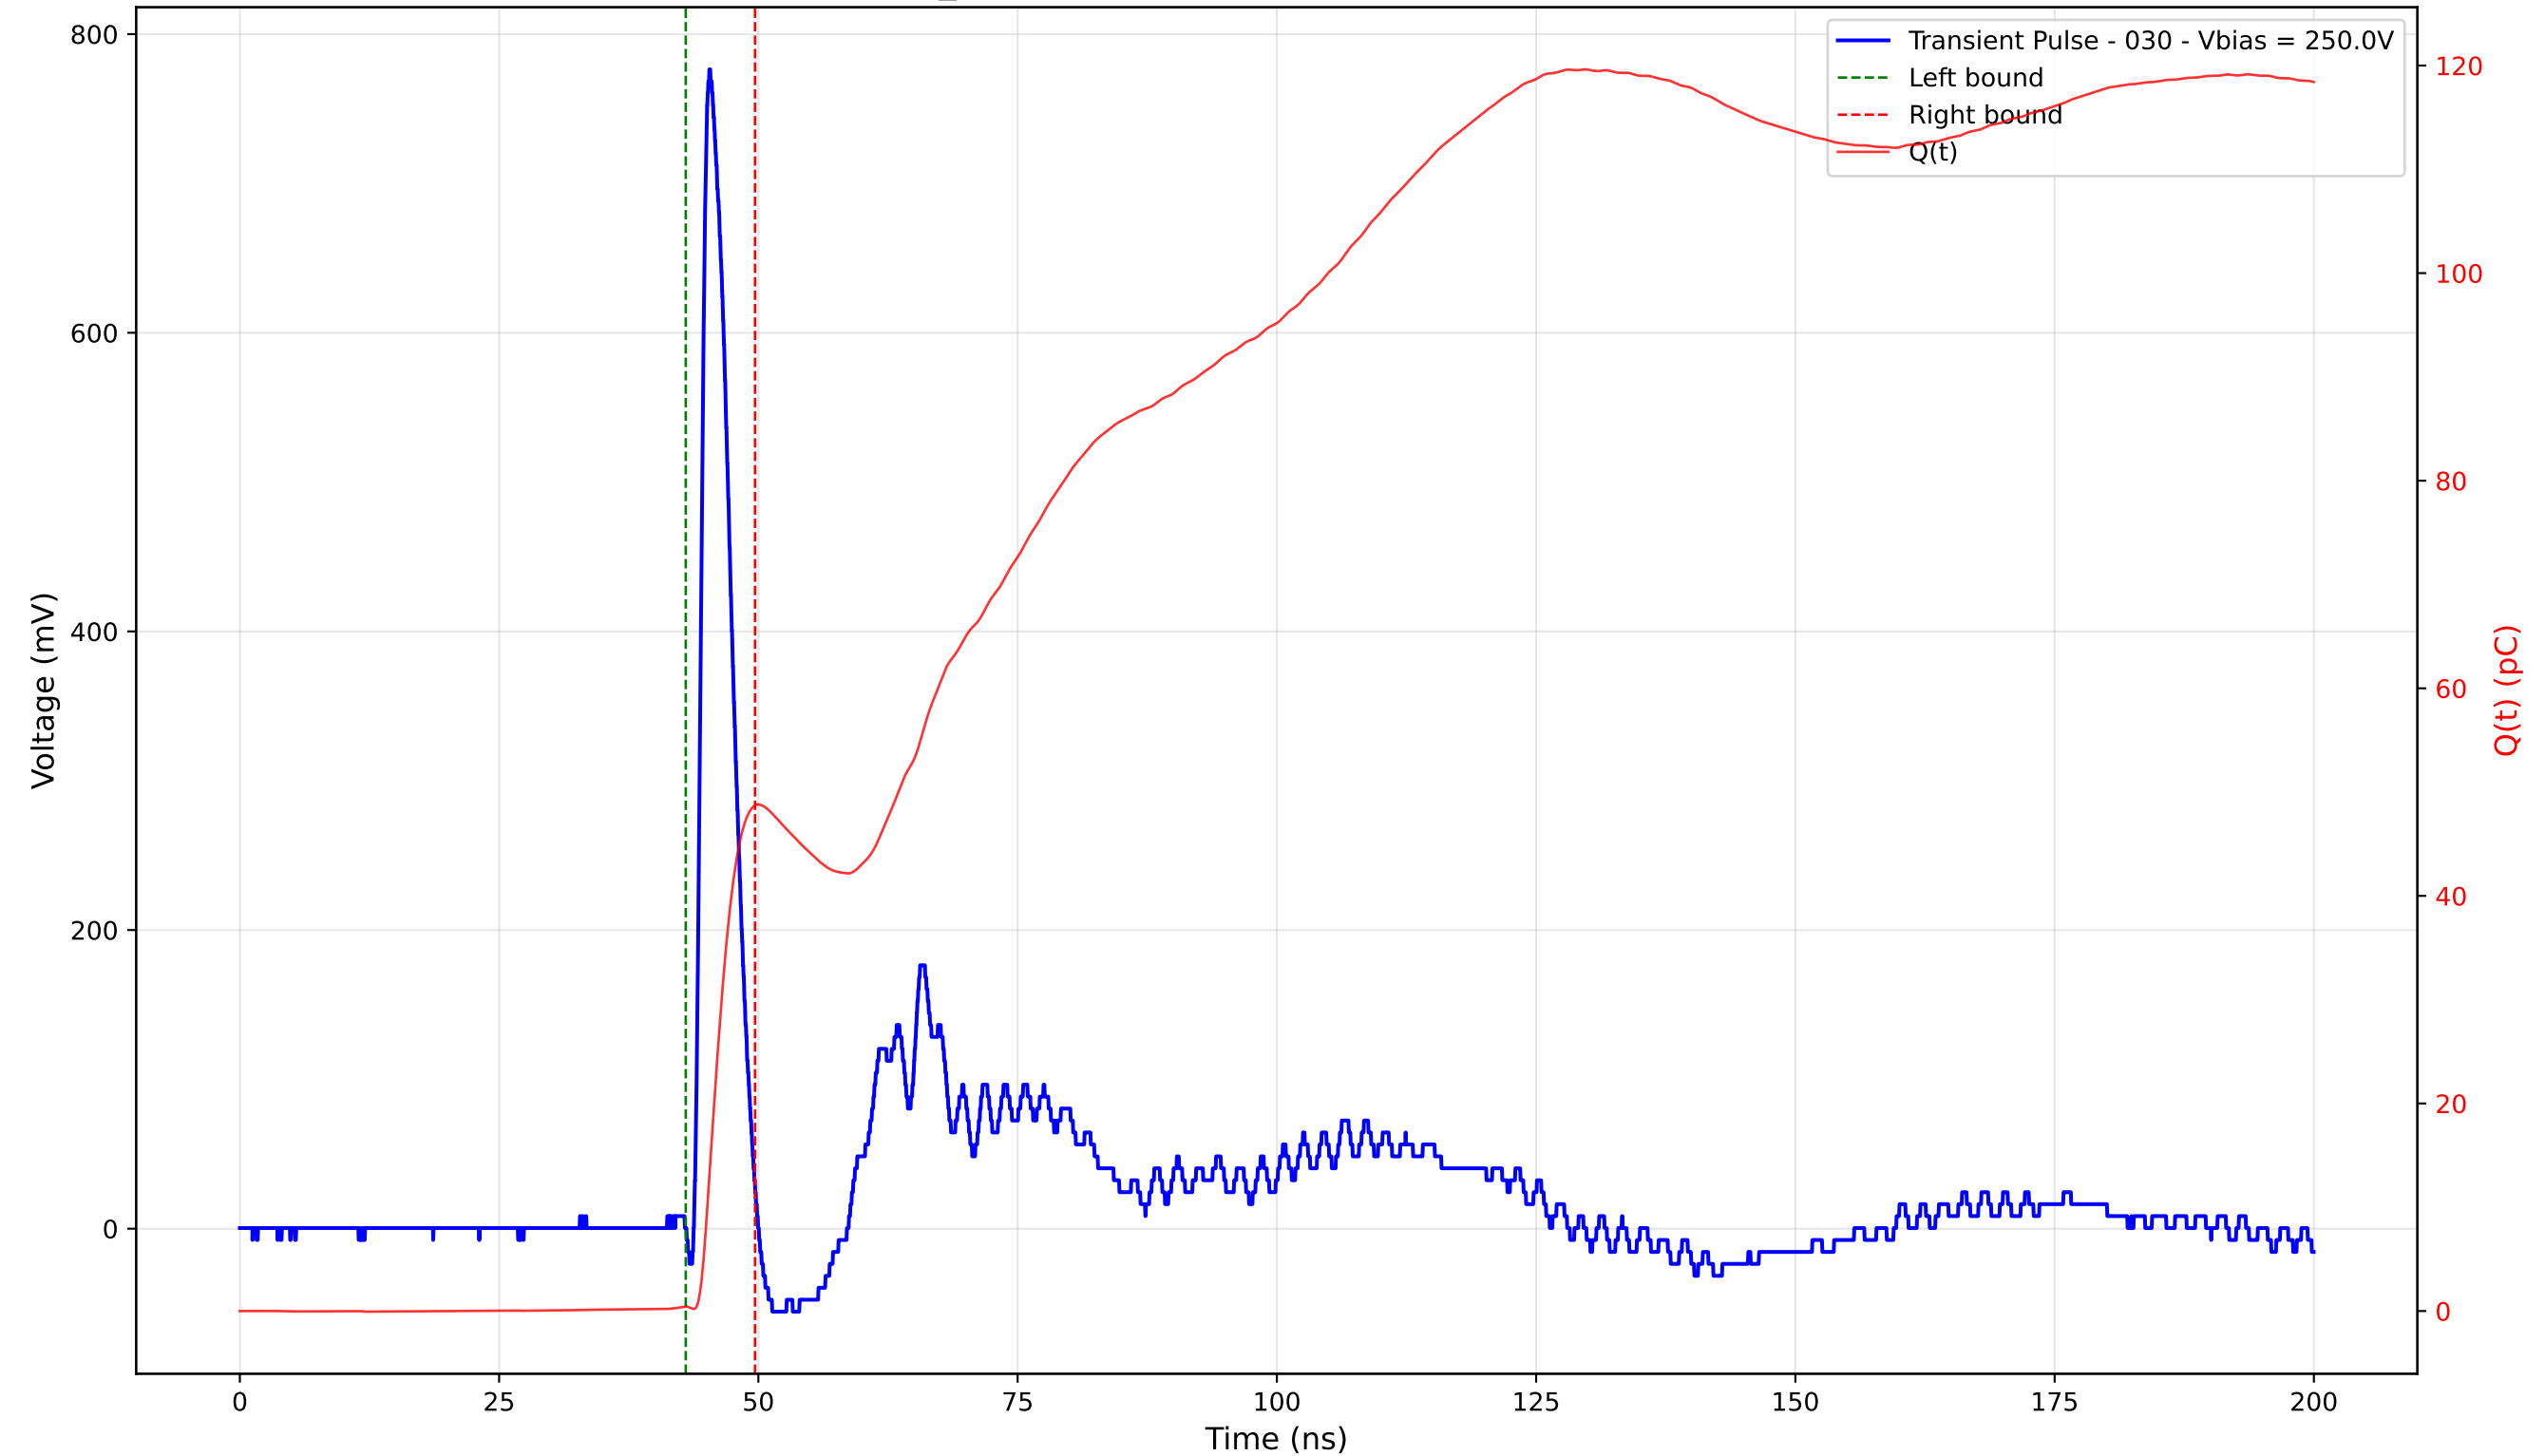


Transient Pulse - Sample: TD_4004 - Position: 175.0 μm - Charge: 48.72 pC - Rise Time: 0.90 ns

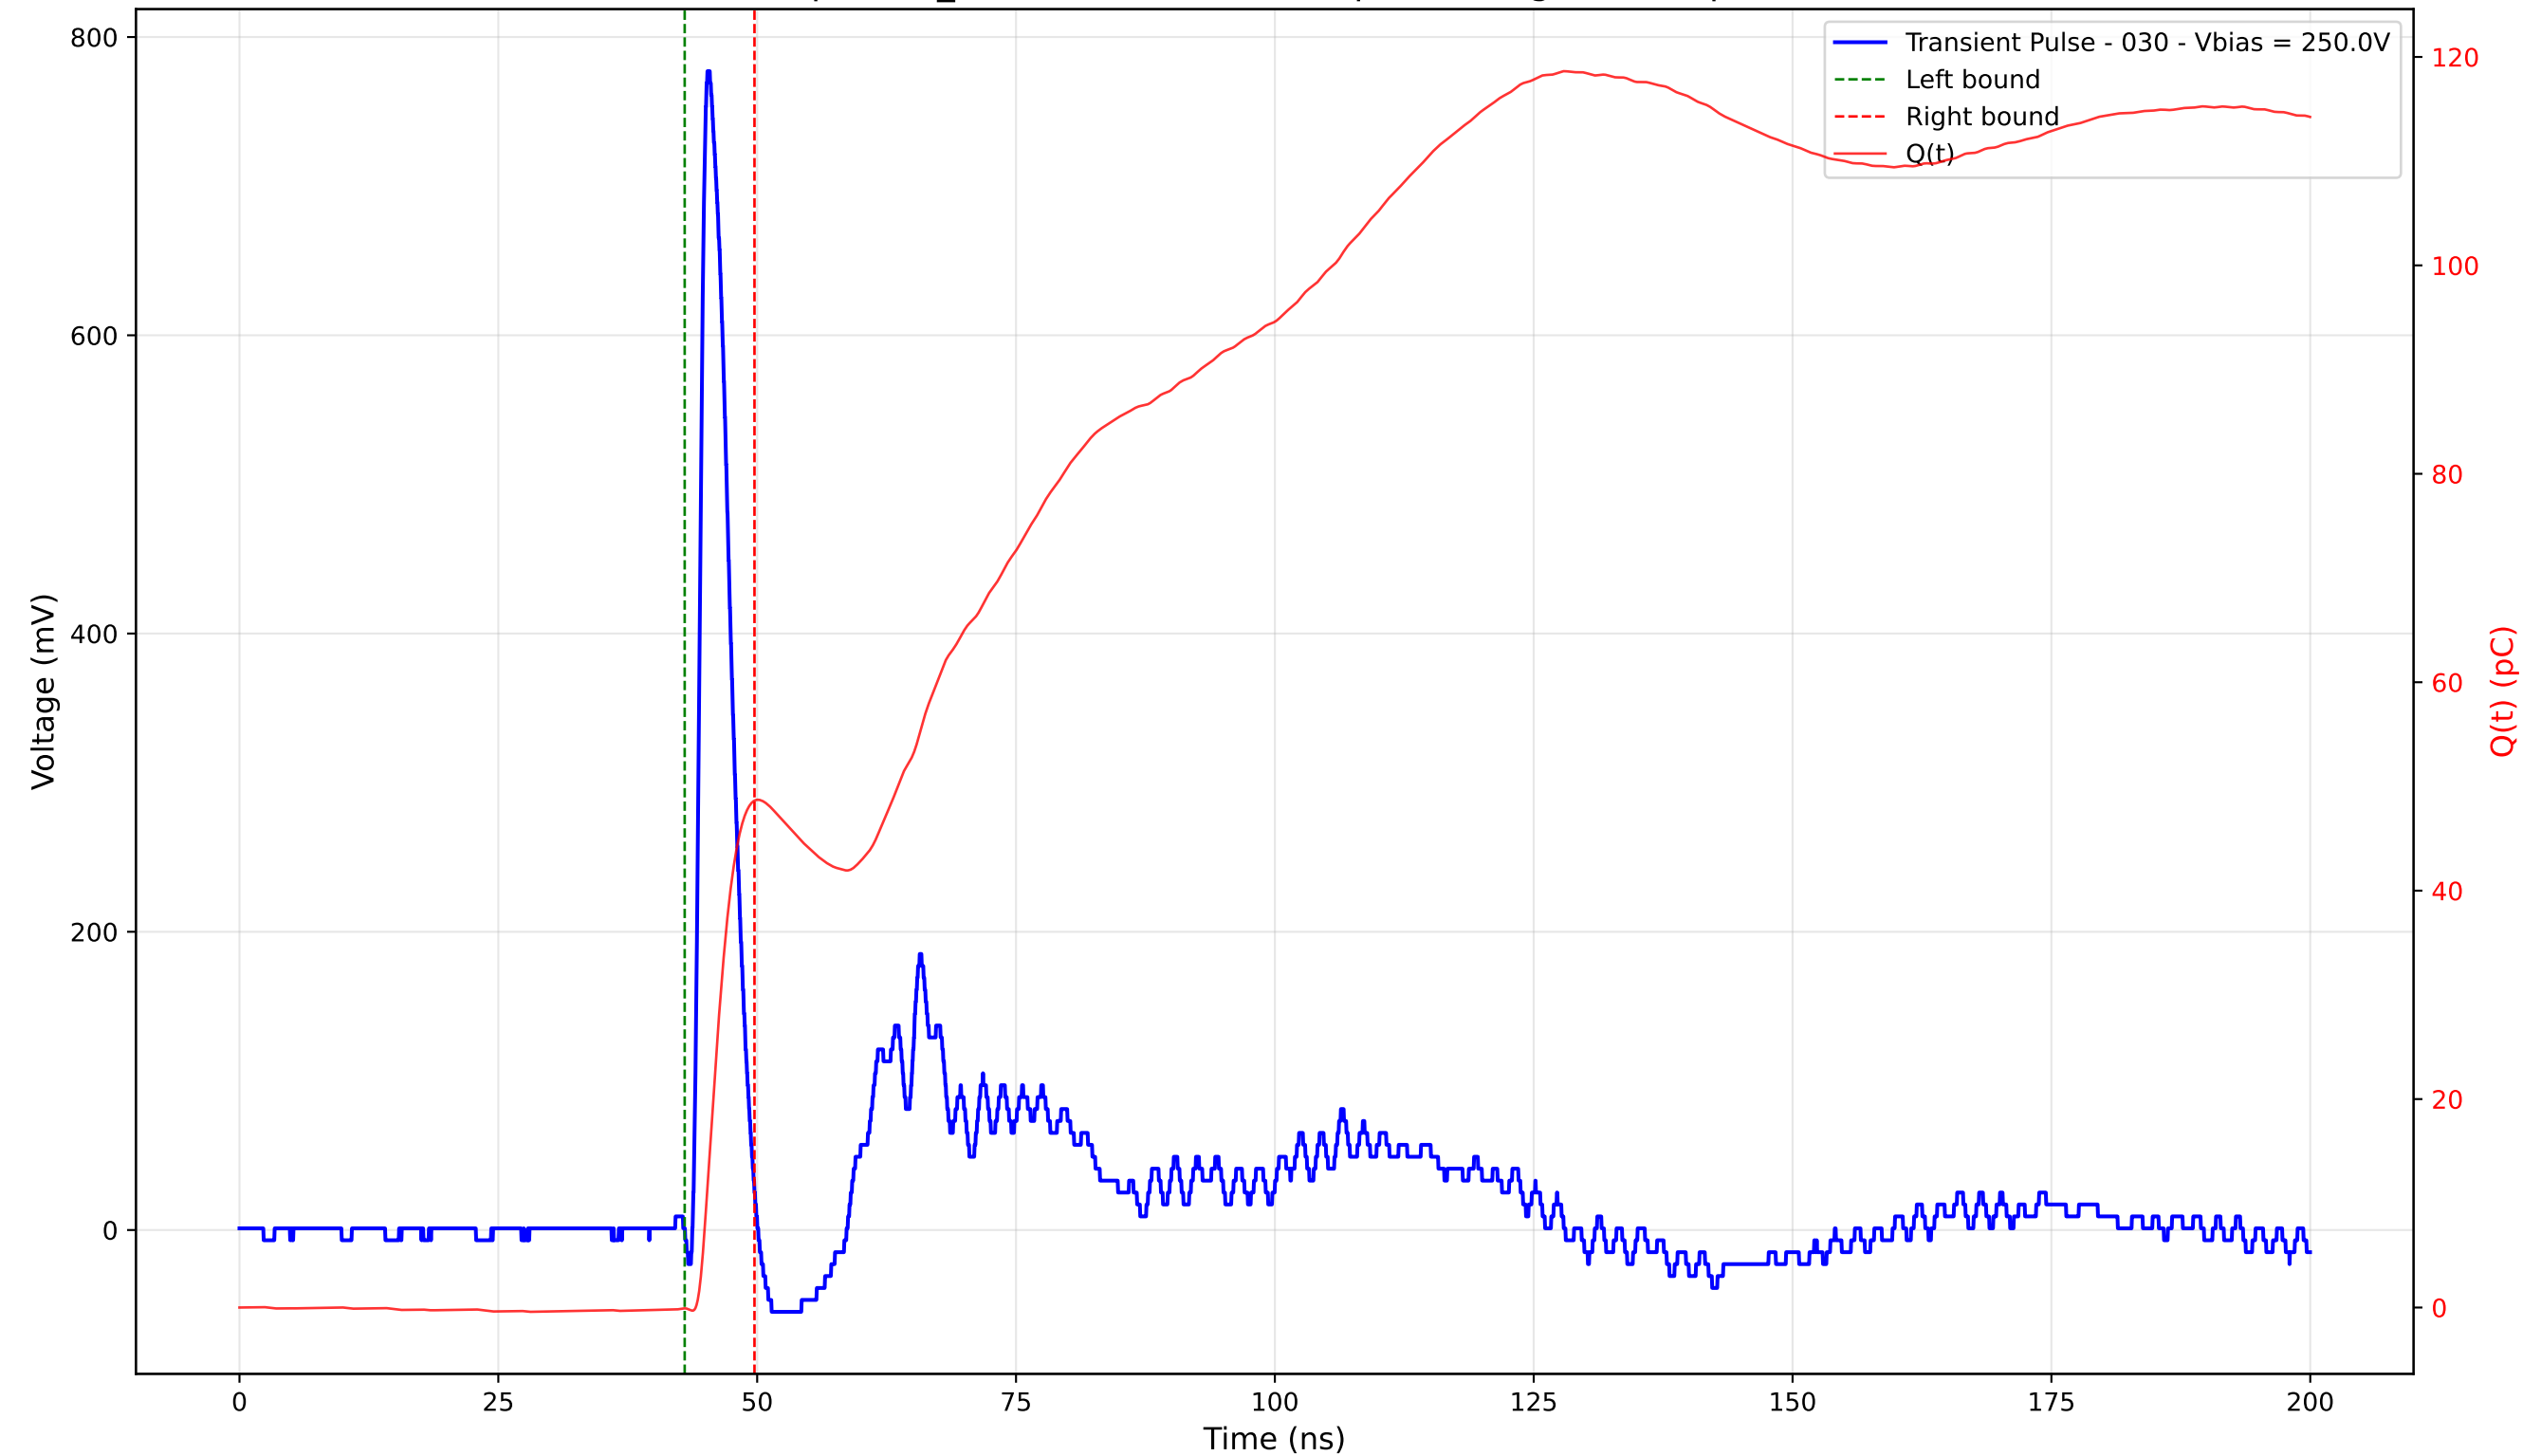


Transient Pulse - Sample: TD_4004 - Position: 180.0 μm - Charge: 49.05 pC - Rise Time: 0.91 ns

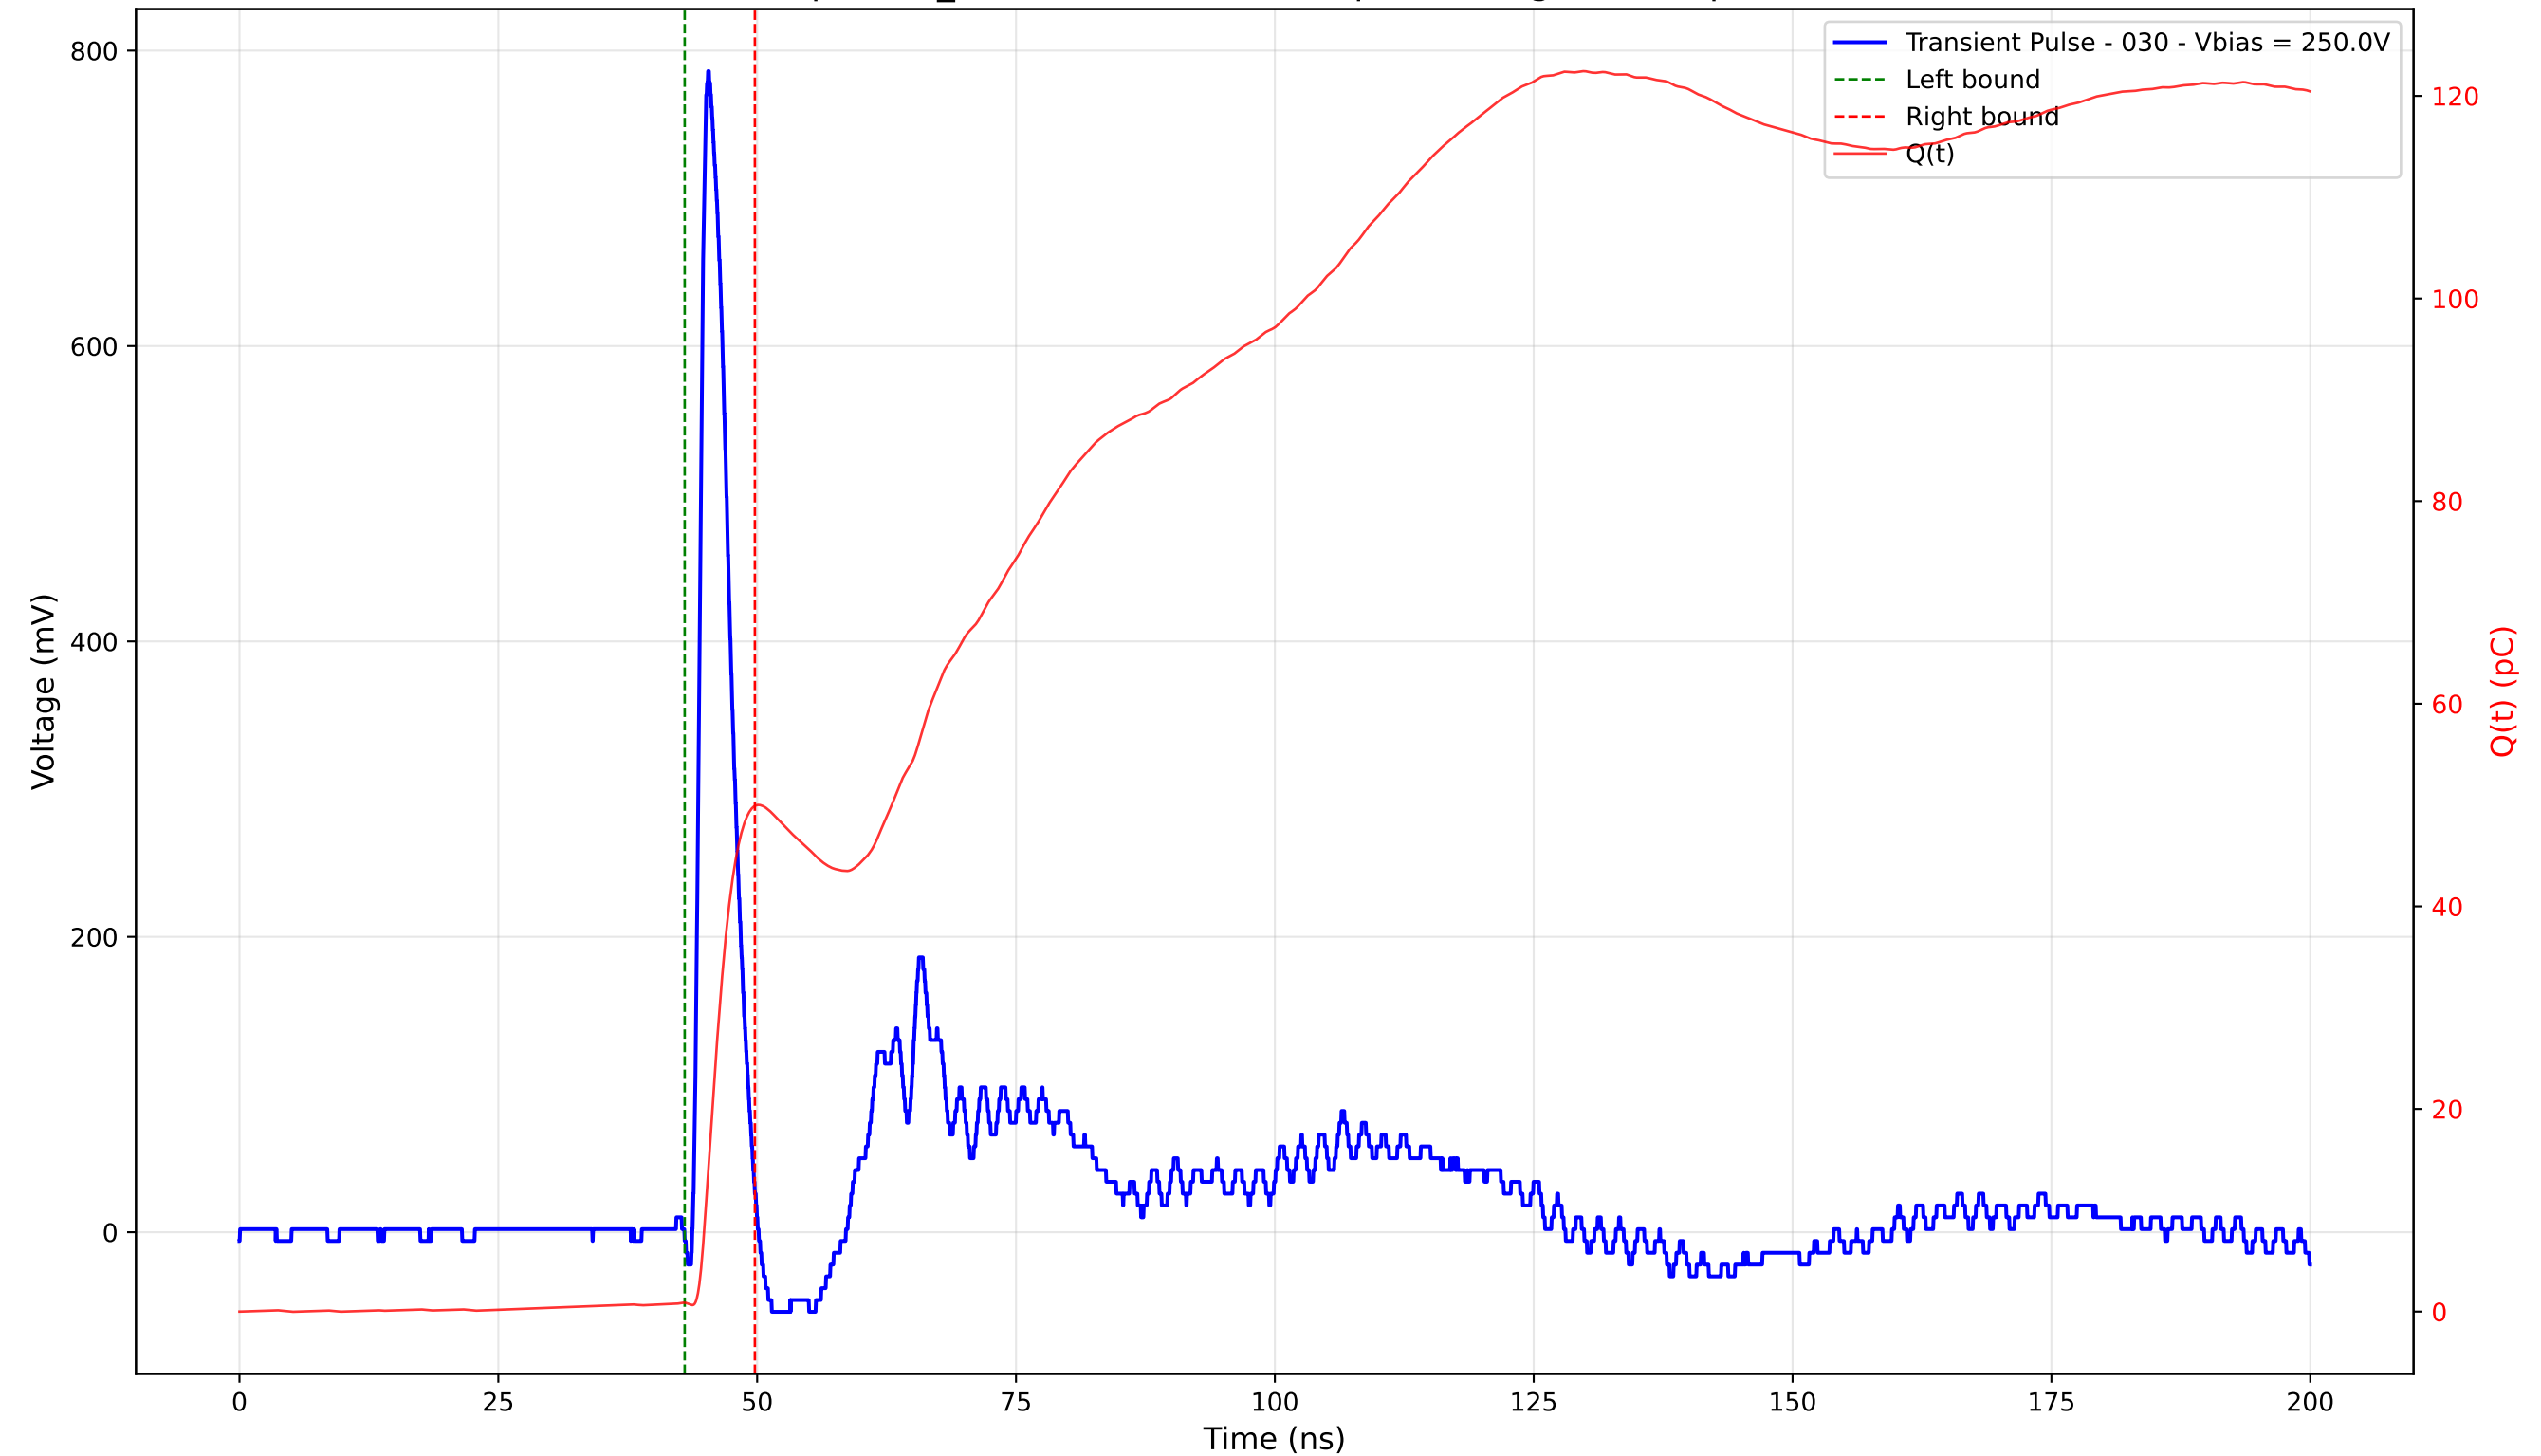


Transient Pulse - Sample: TD_4004 - Position: 185.0 μm - Charge: 49.01 pC - Rise Time: 0.89 ns

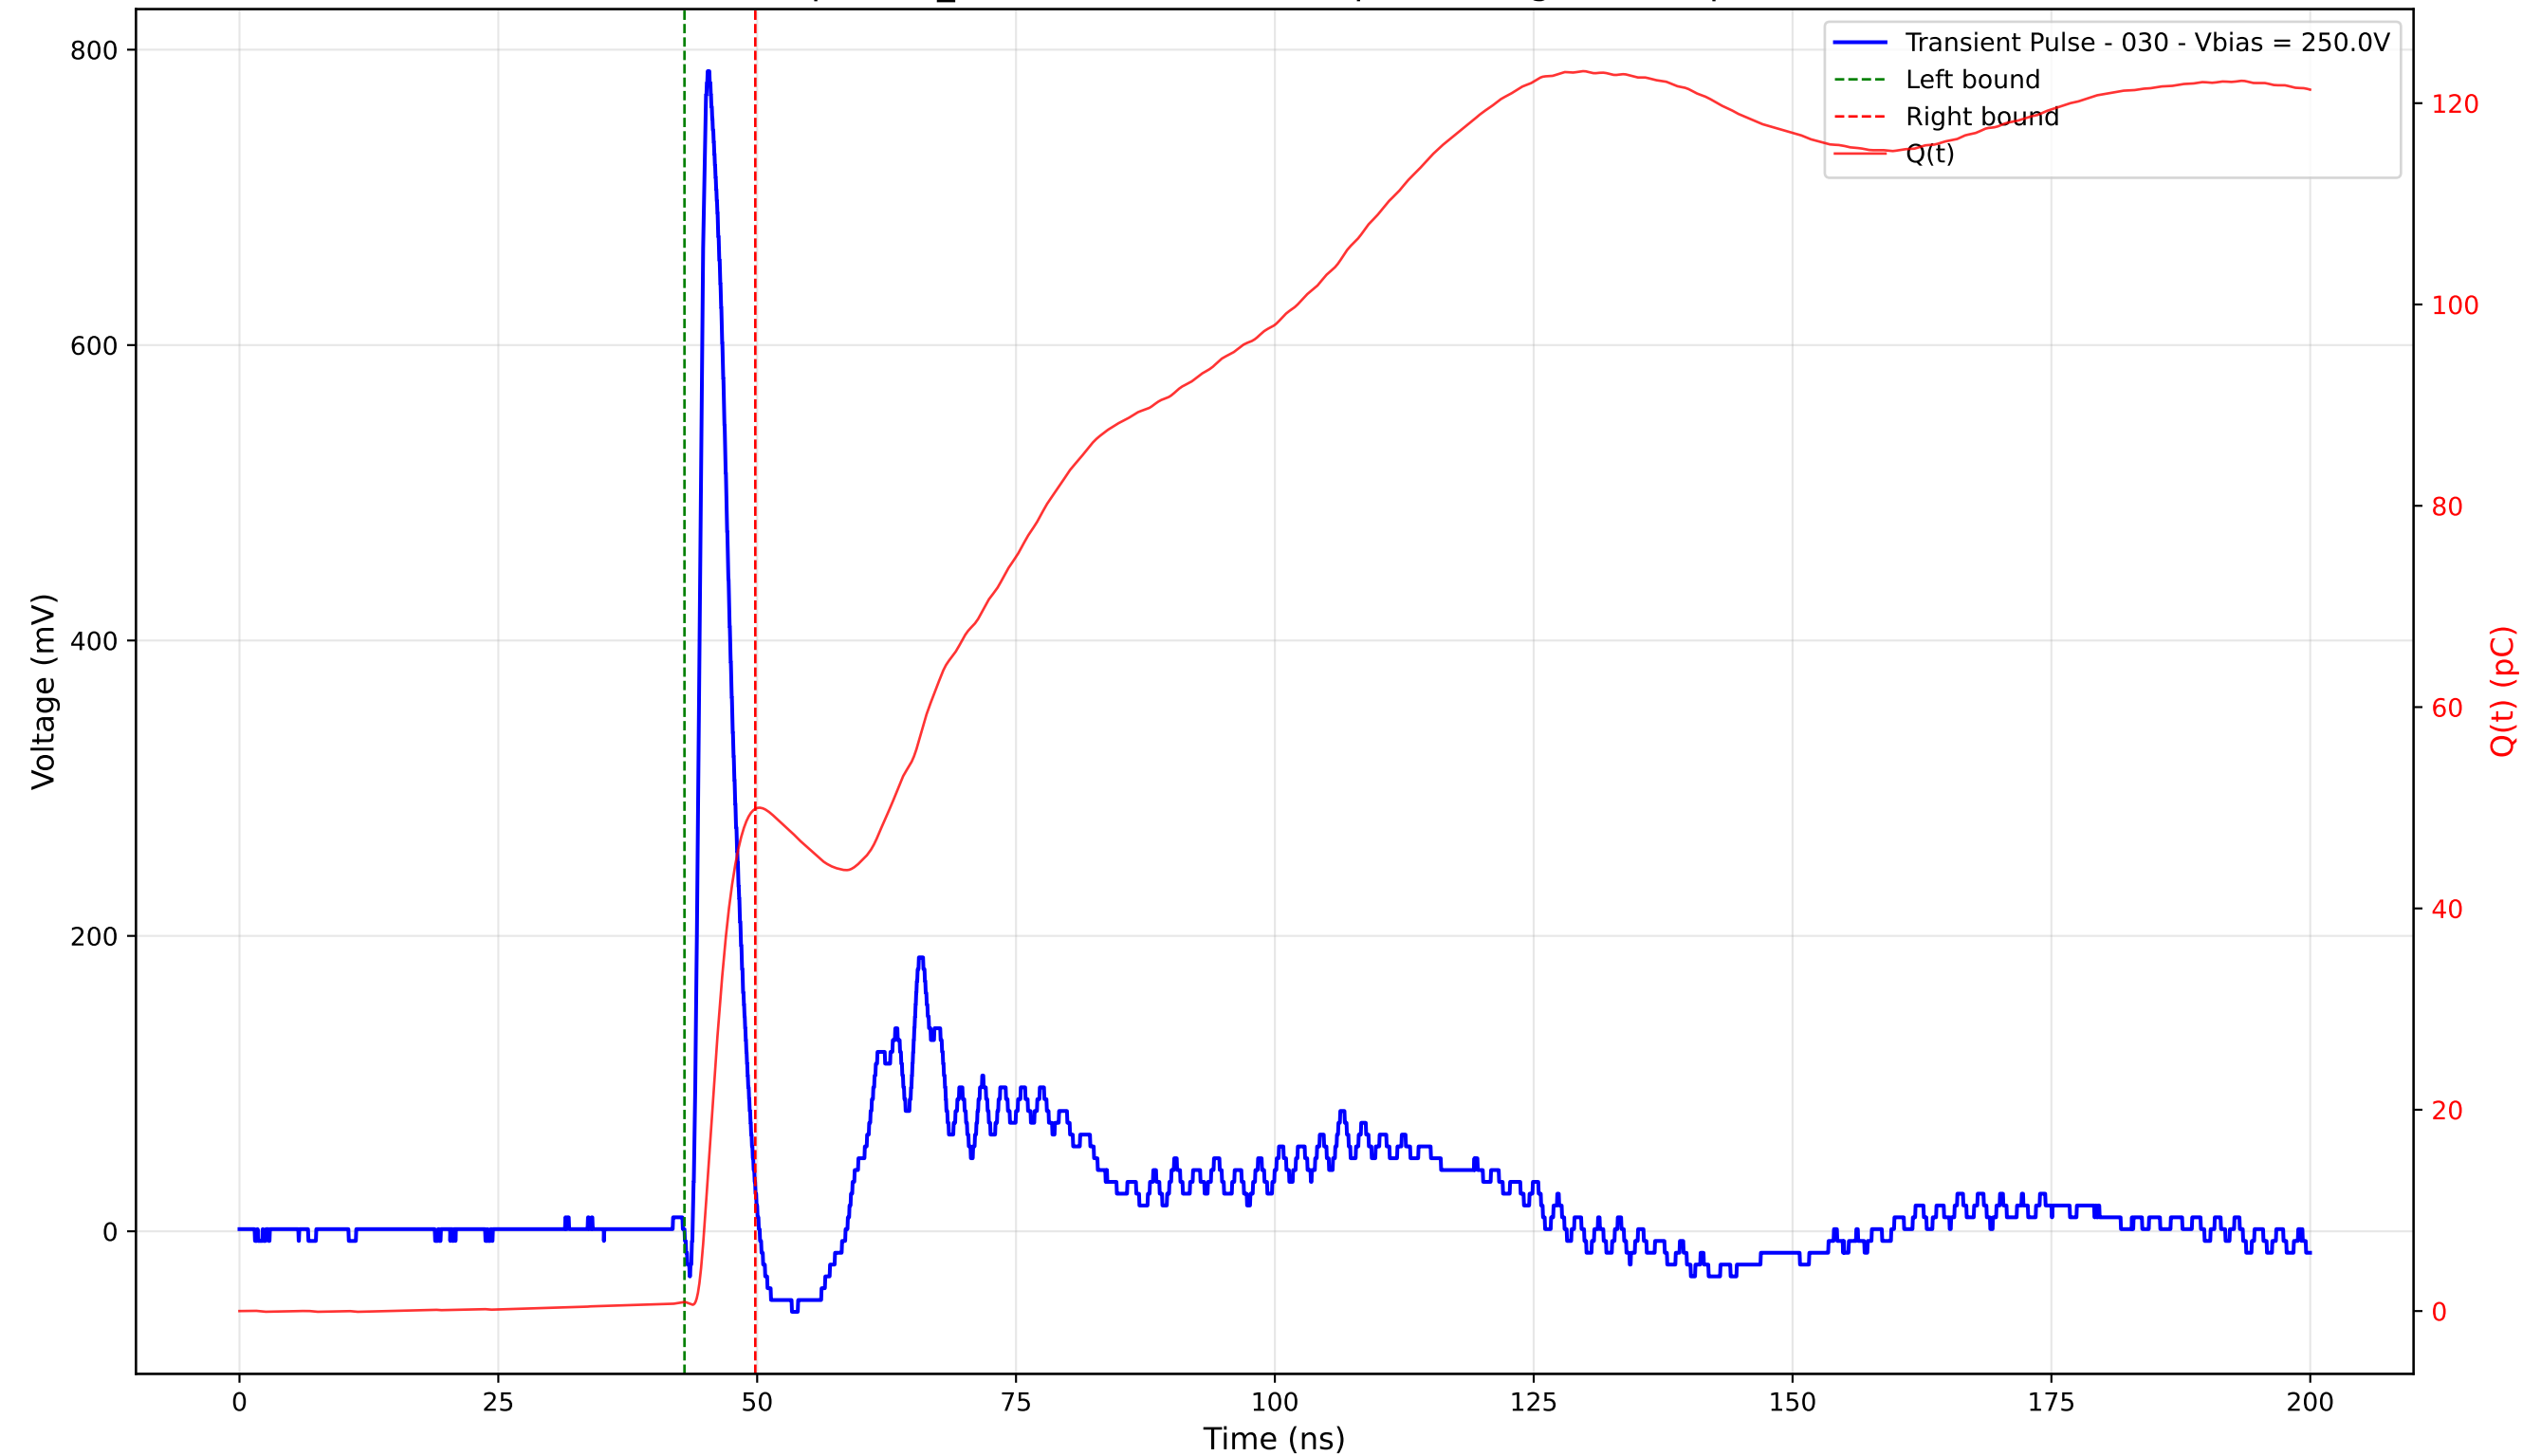


Transient Pulse - Sample: TD_4004 - Position: 190.0 μm - Charge: 49.00 pC - Rise Time: 0.89 ns

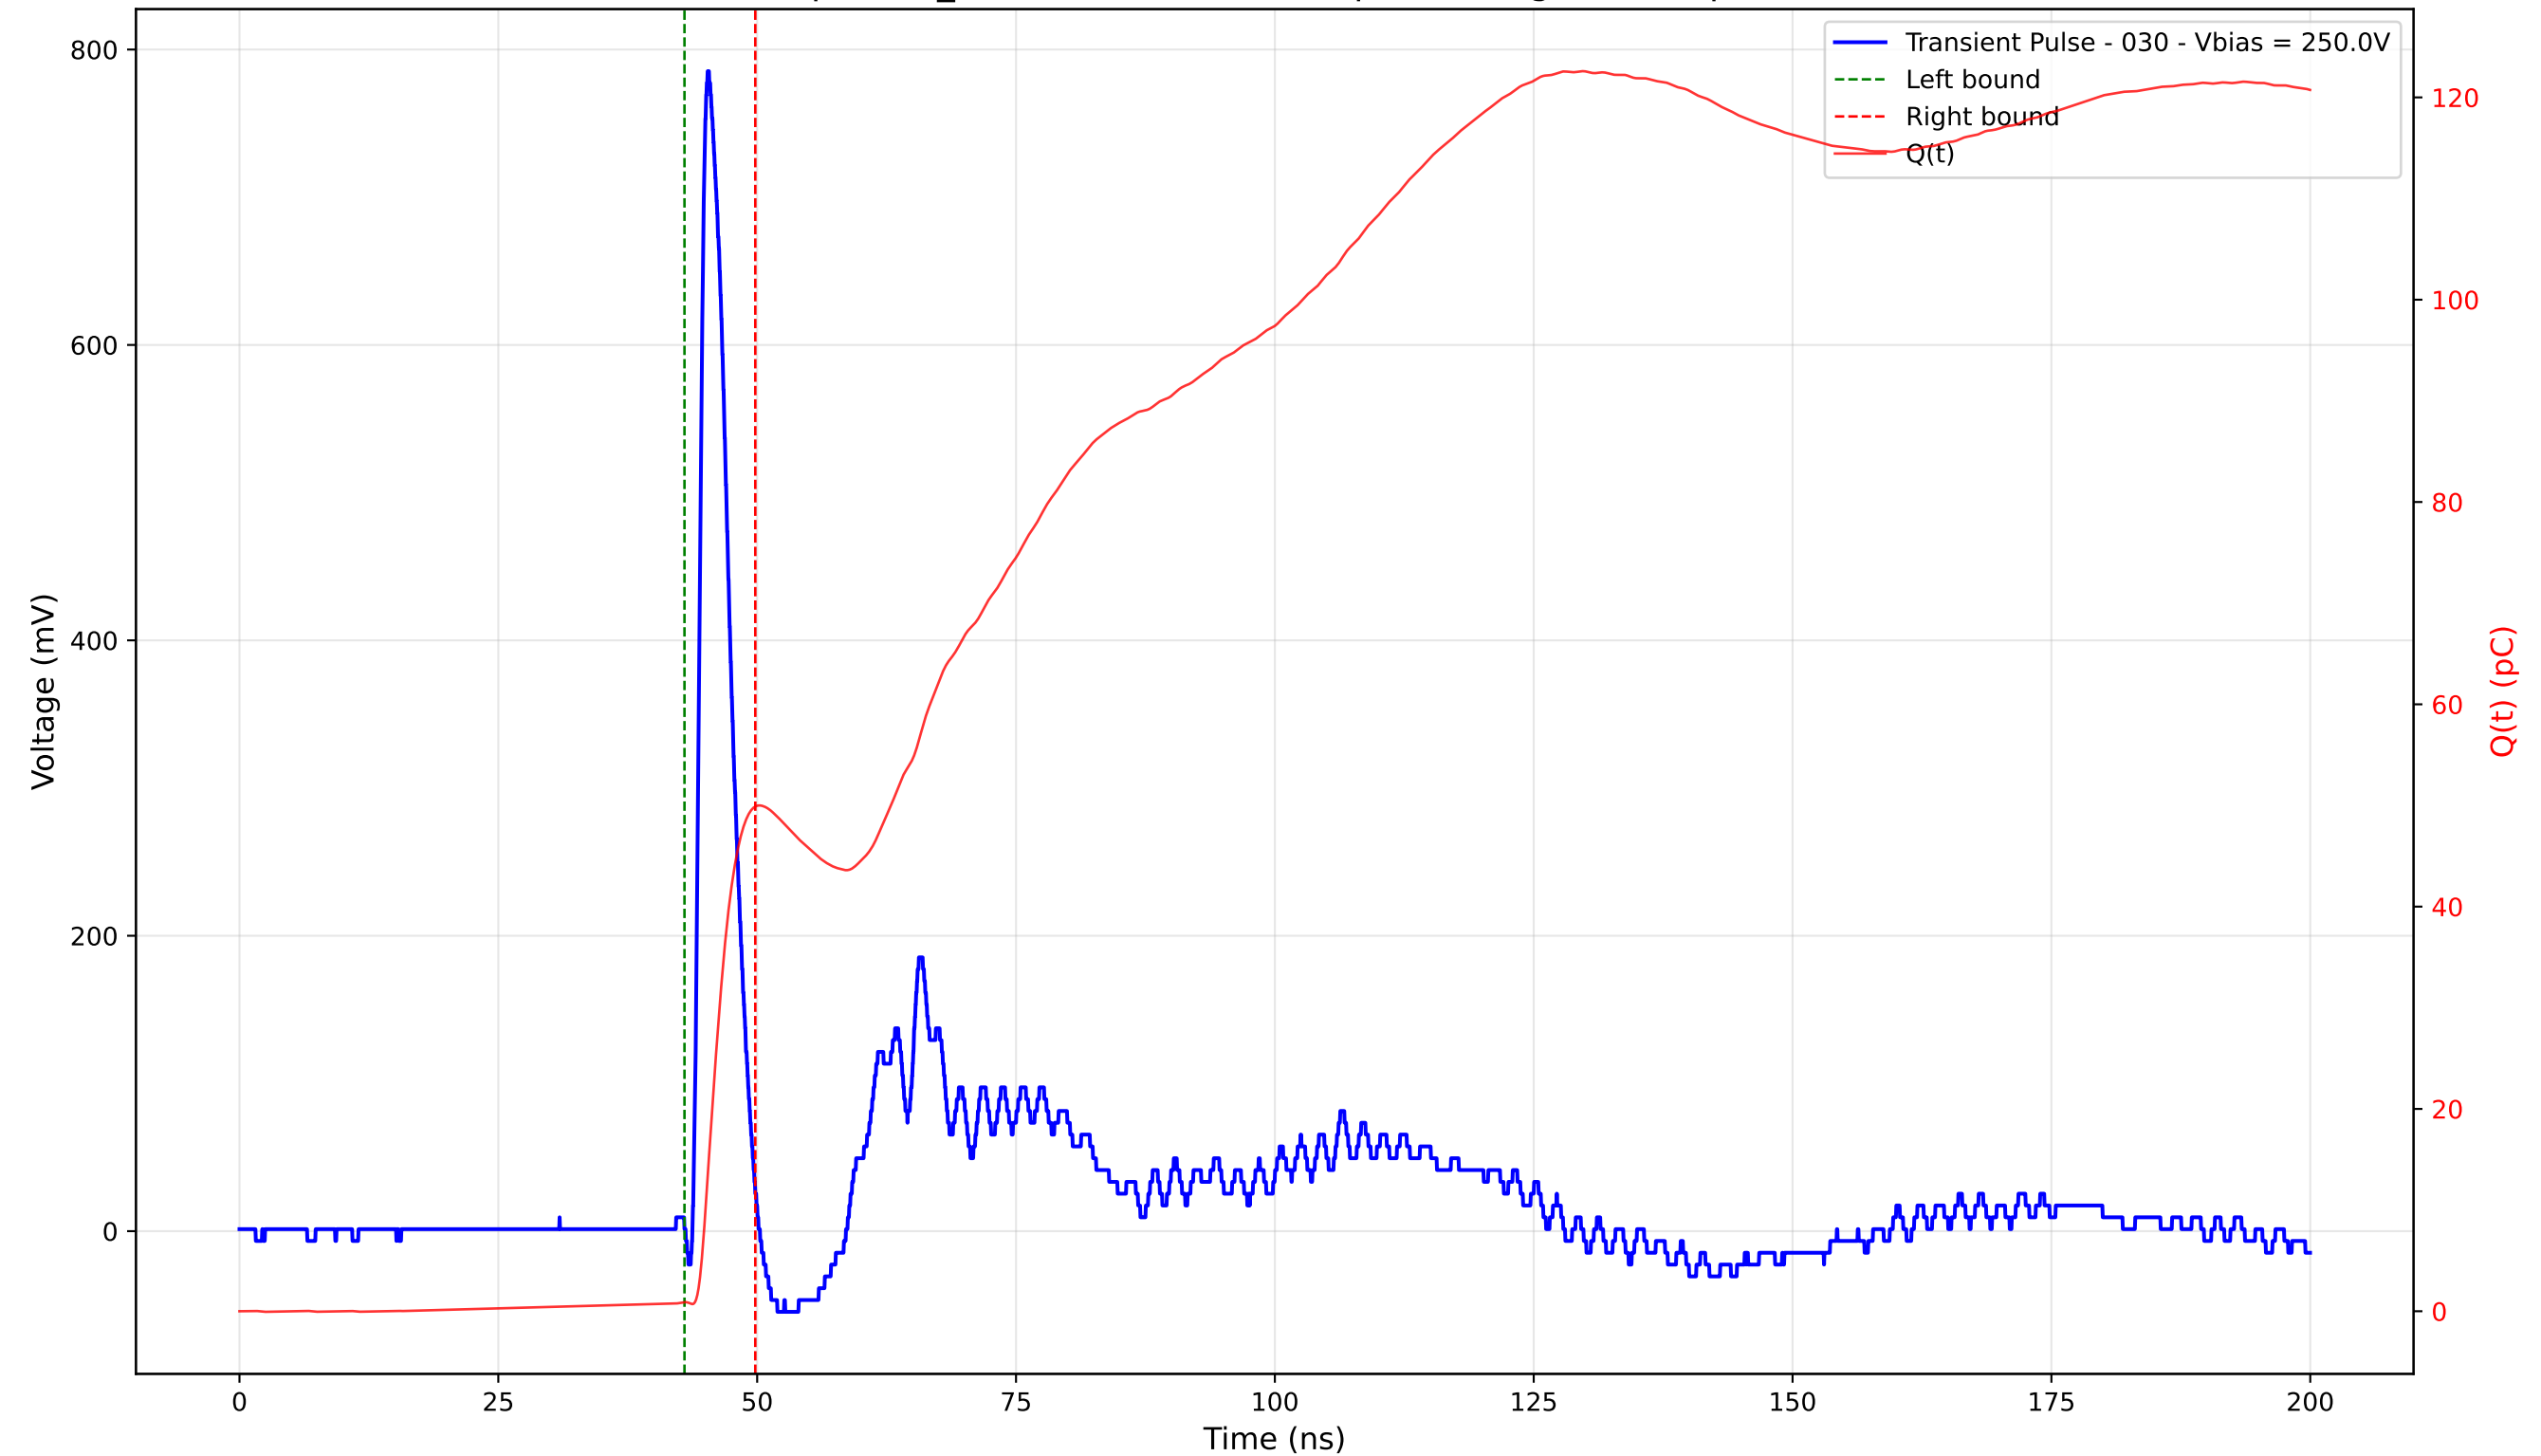


Transient Pulse - Sample: TD_4004 - Position: 195.0 μm - Charge: 49.00 pC - Rise Time: 0.91 ns

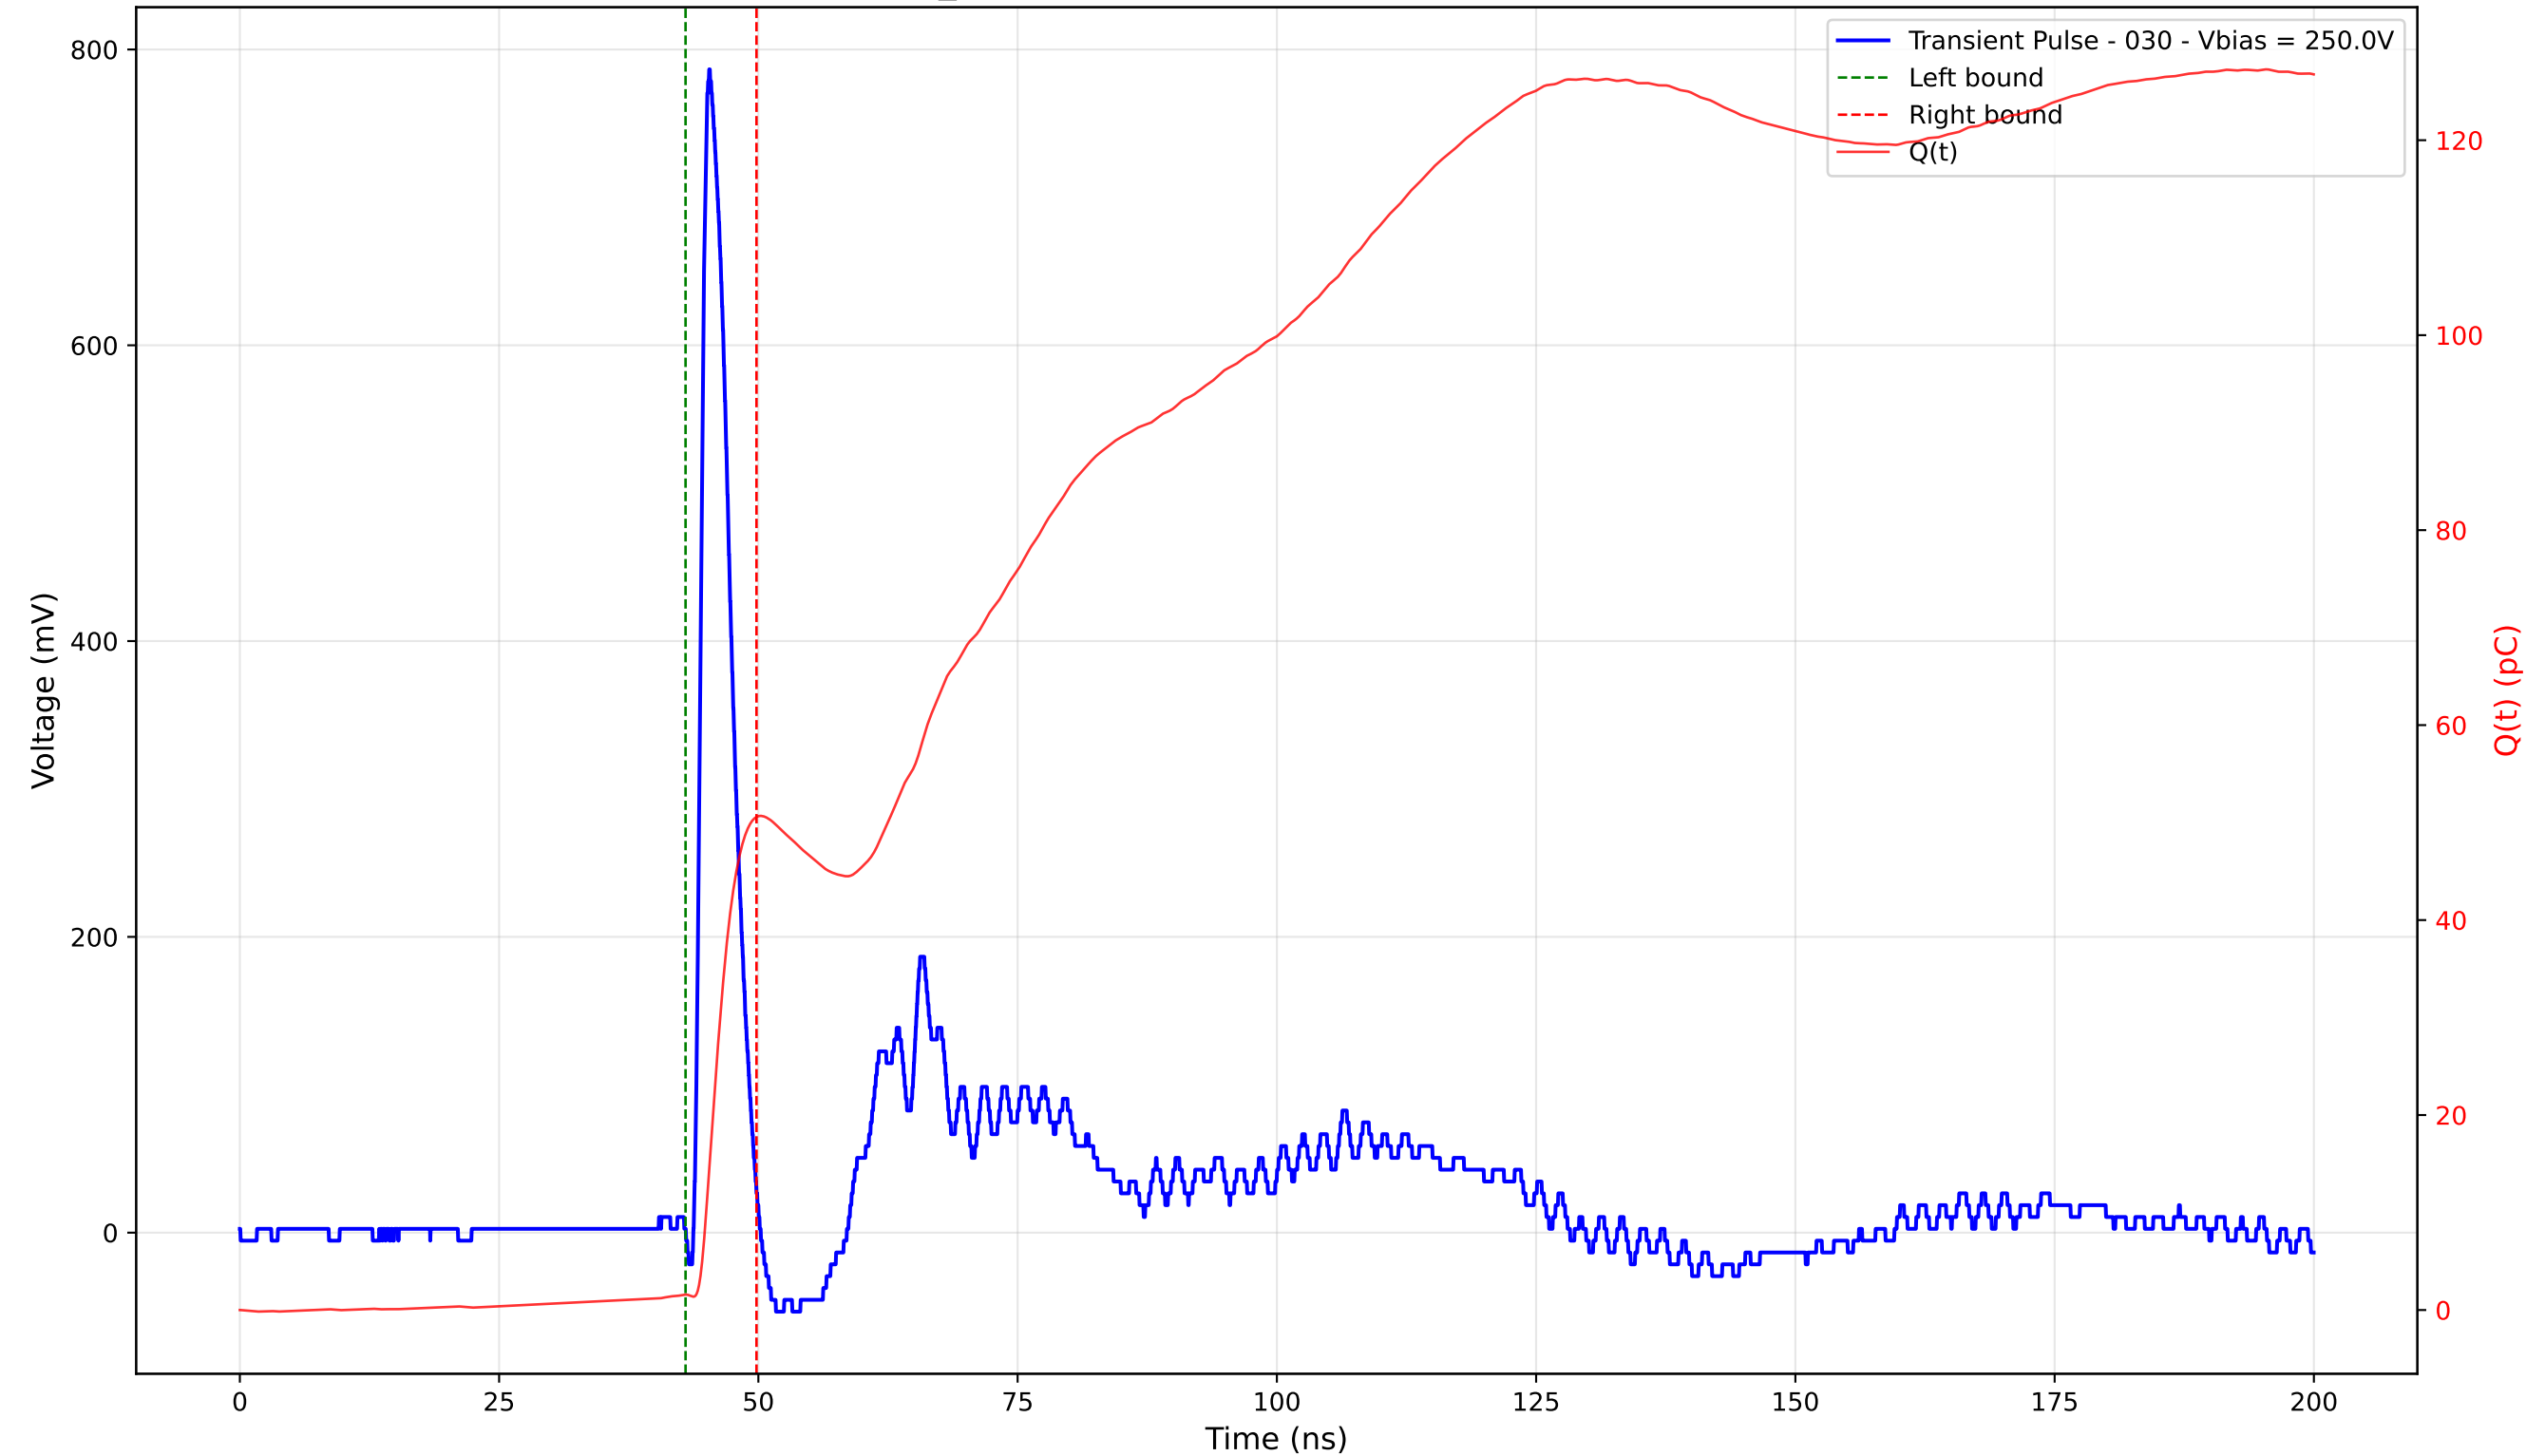


Transient Pulse - Sample: TD_4004 - Position: 200.0 μm - Charge: 48.58 pC - Rise Time: 0.89 ns

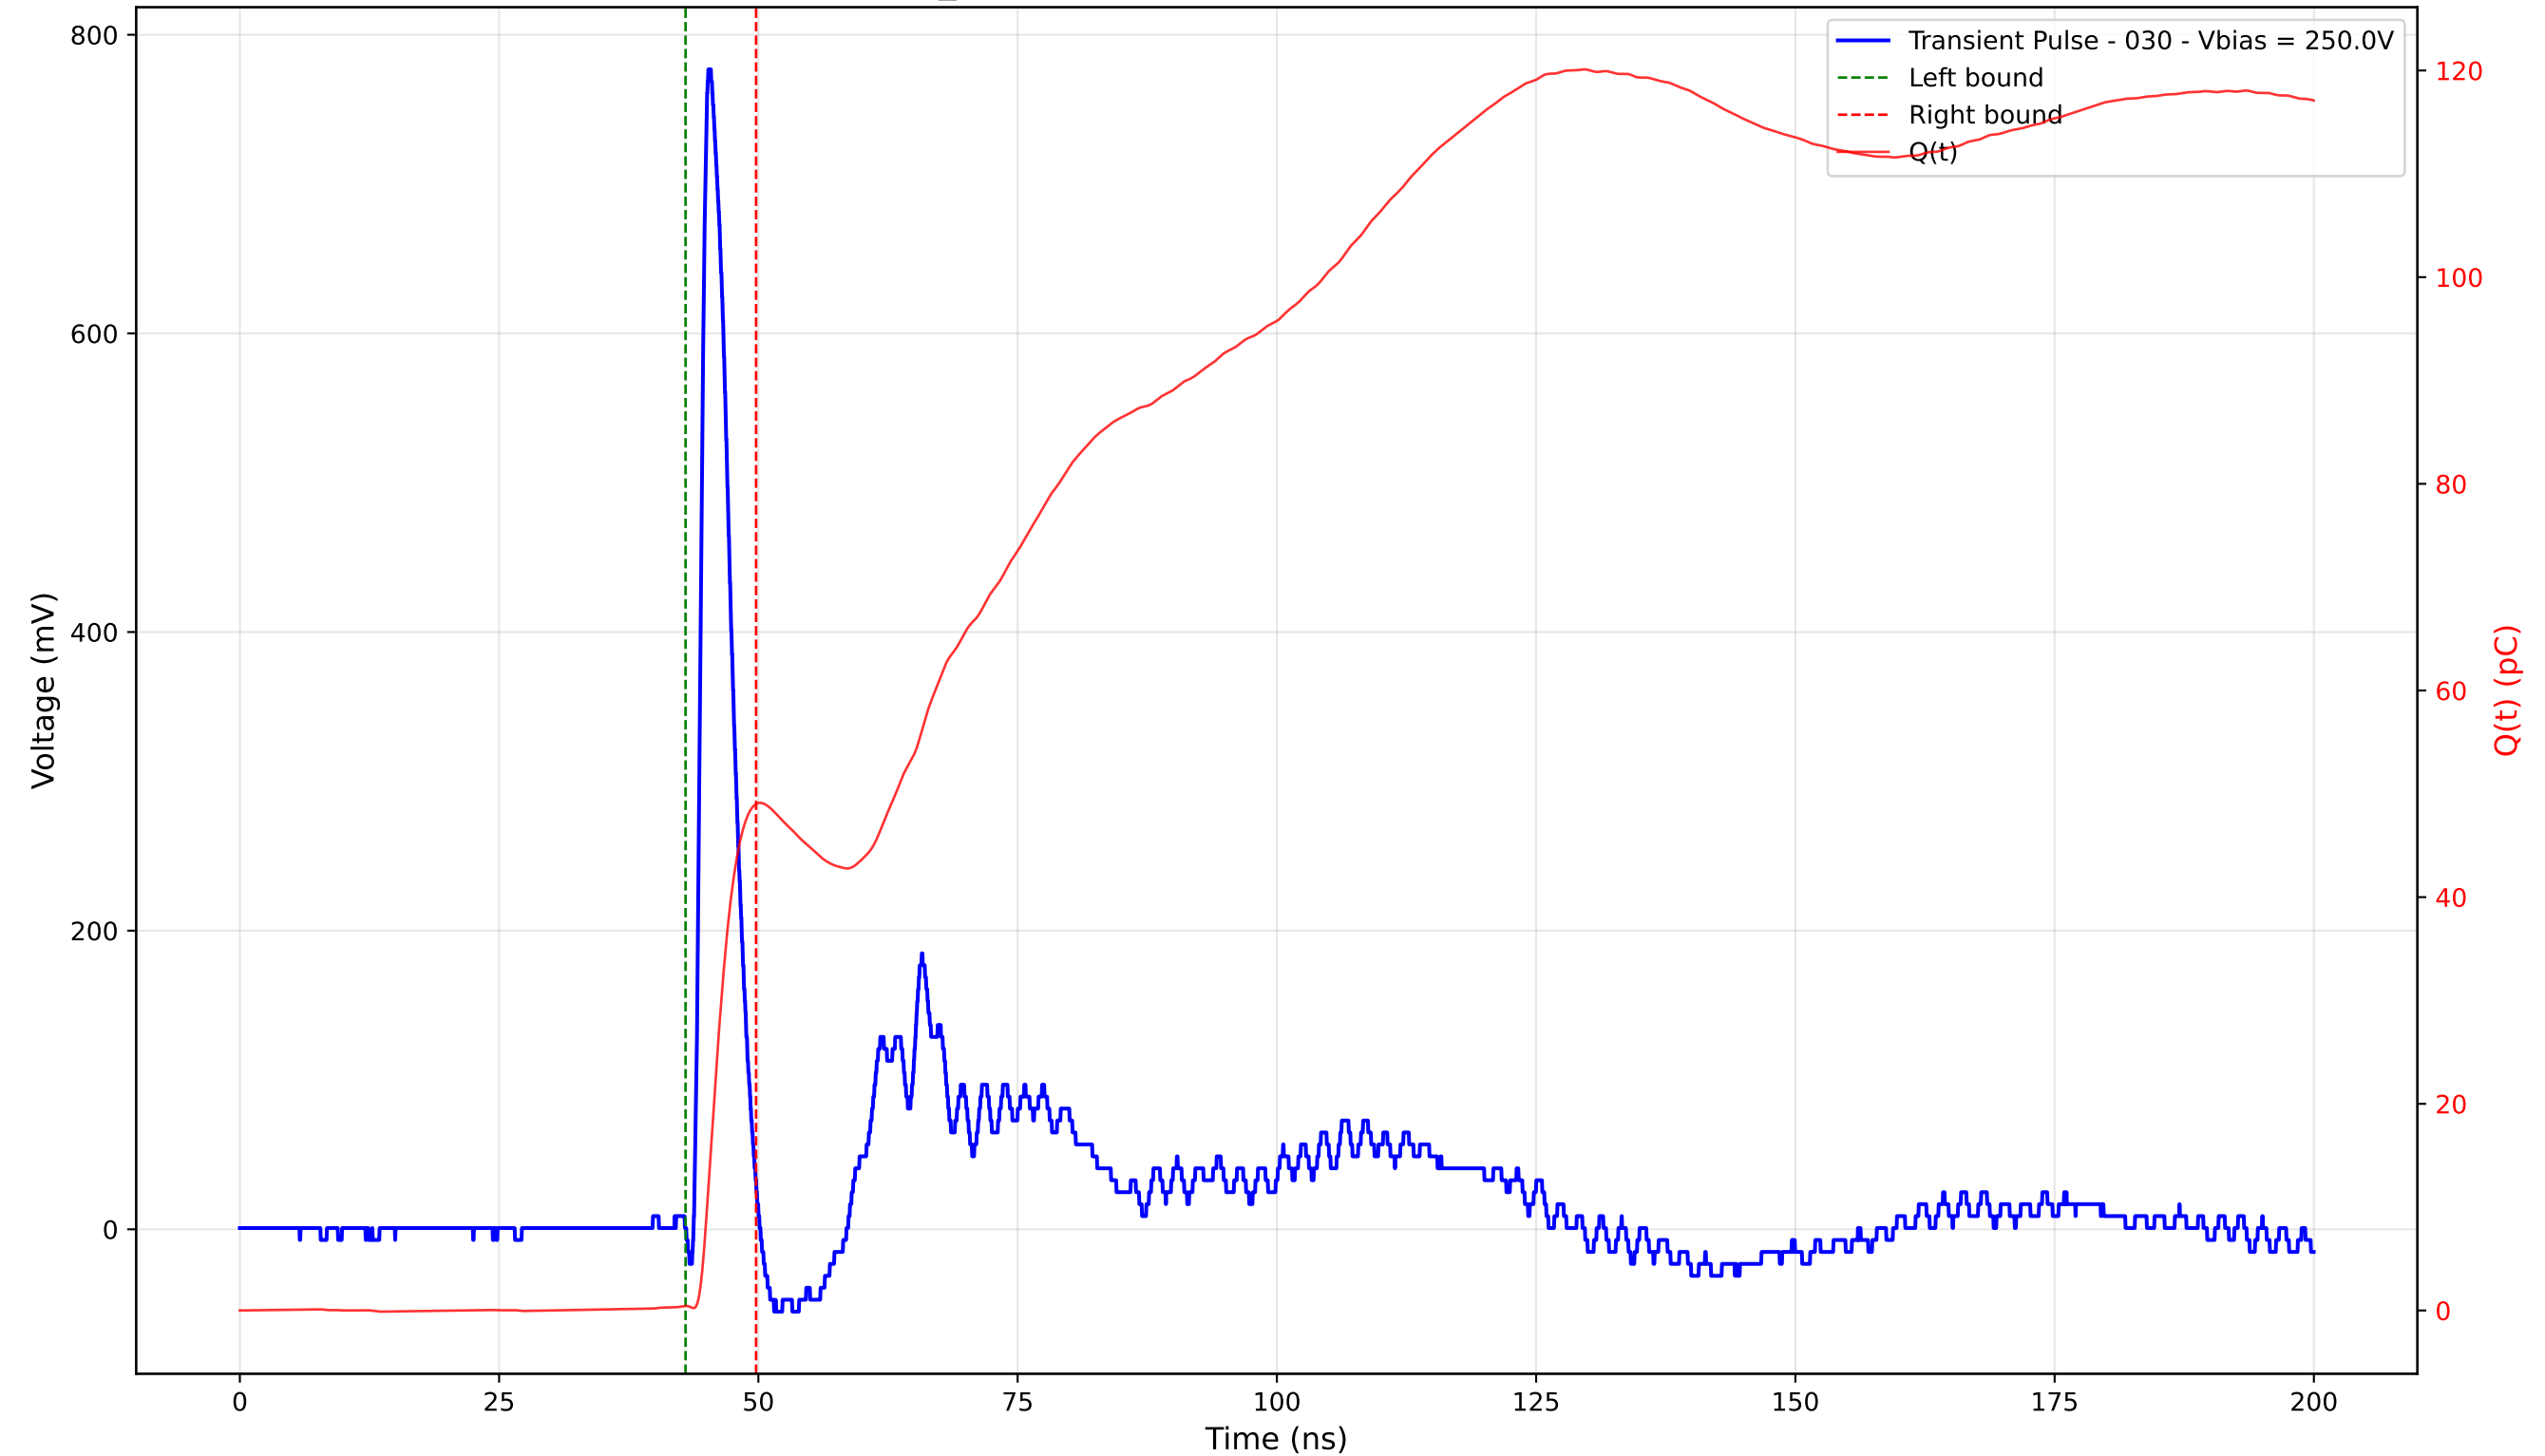


Transient Pulse - Sample: TD_4004 - Position: 205.0 μm - Charge: 48.03 pC - Rise Time: 0.90 ns

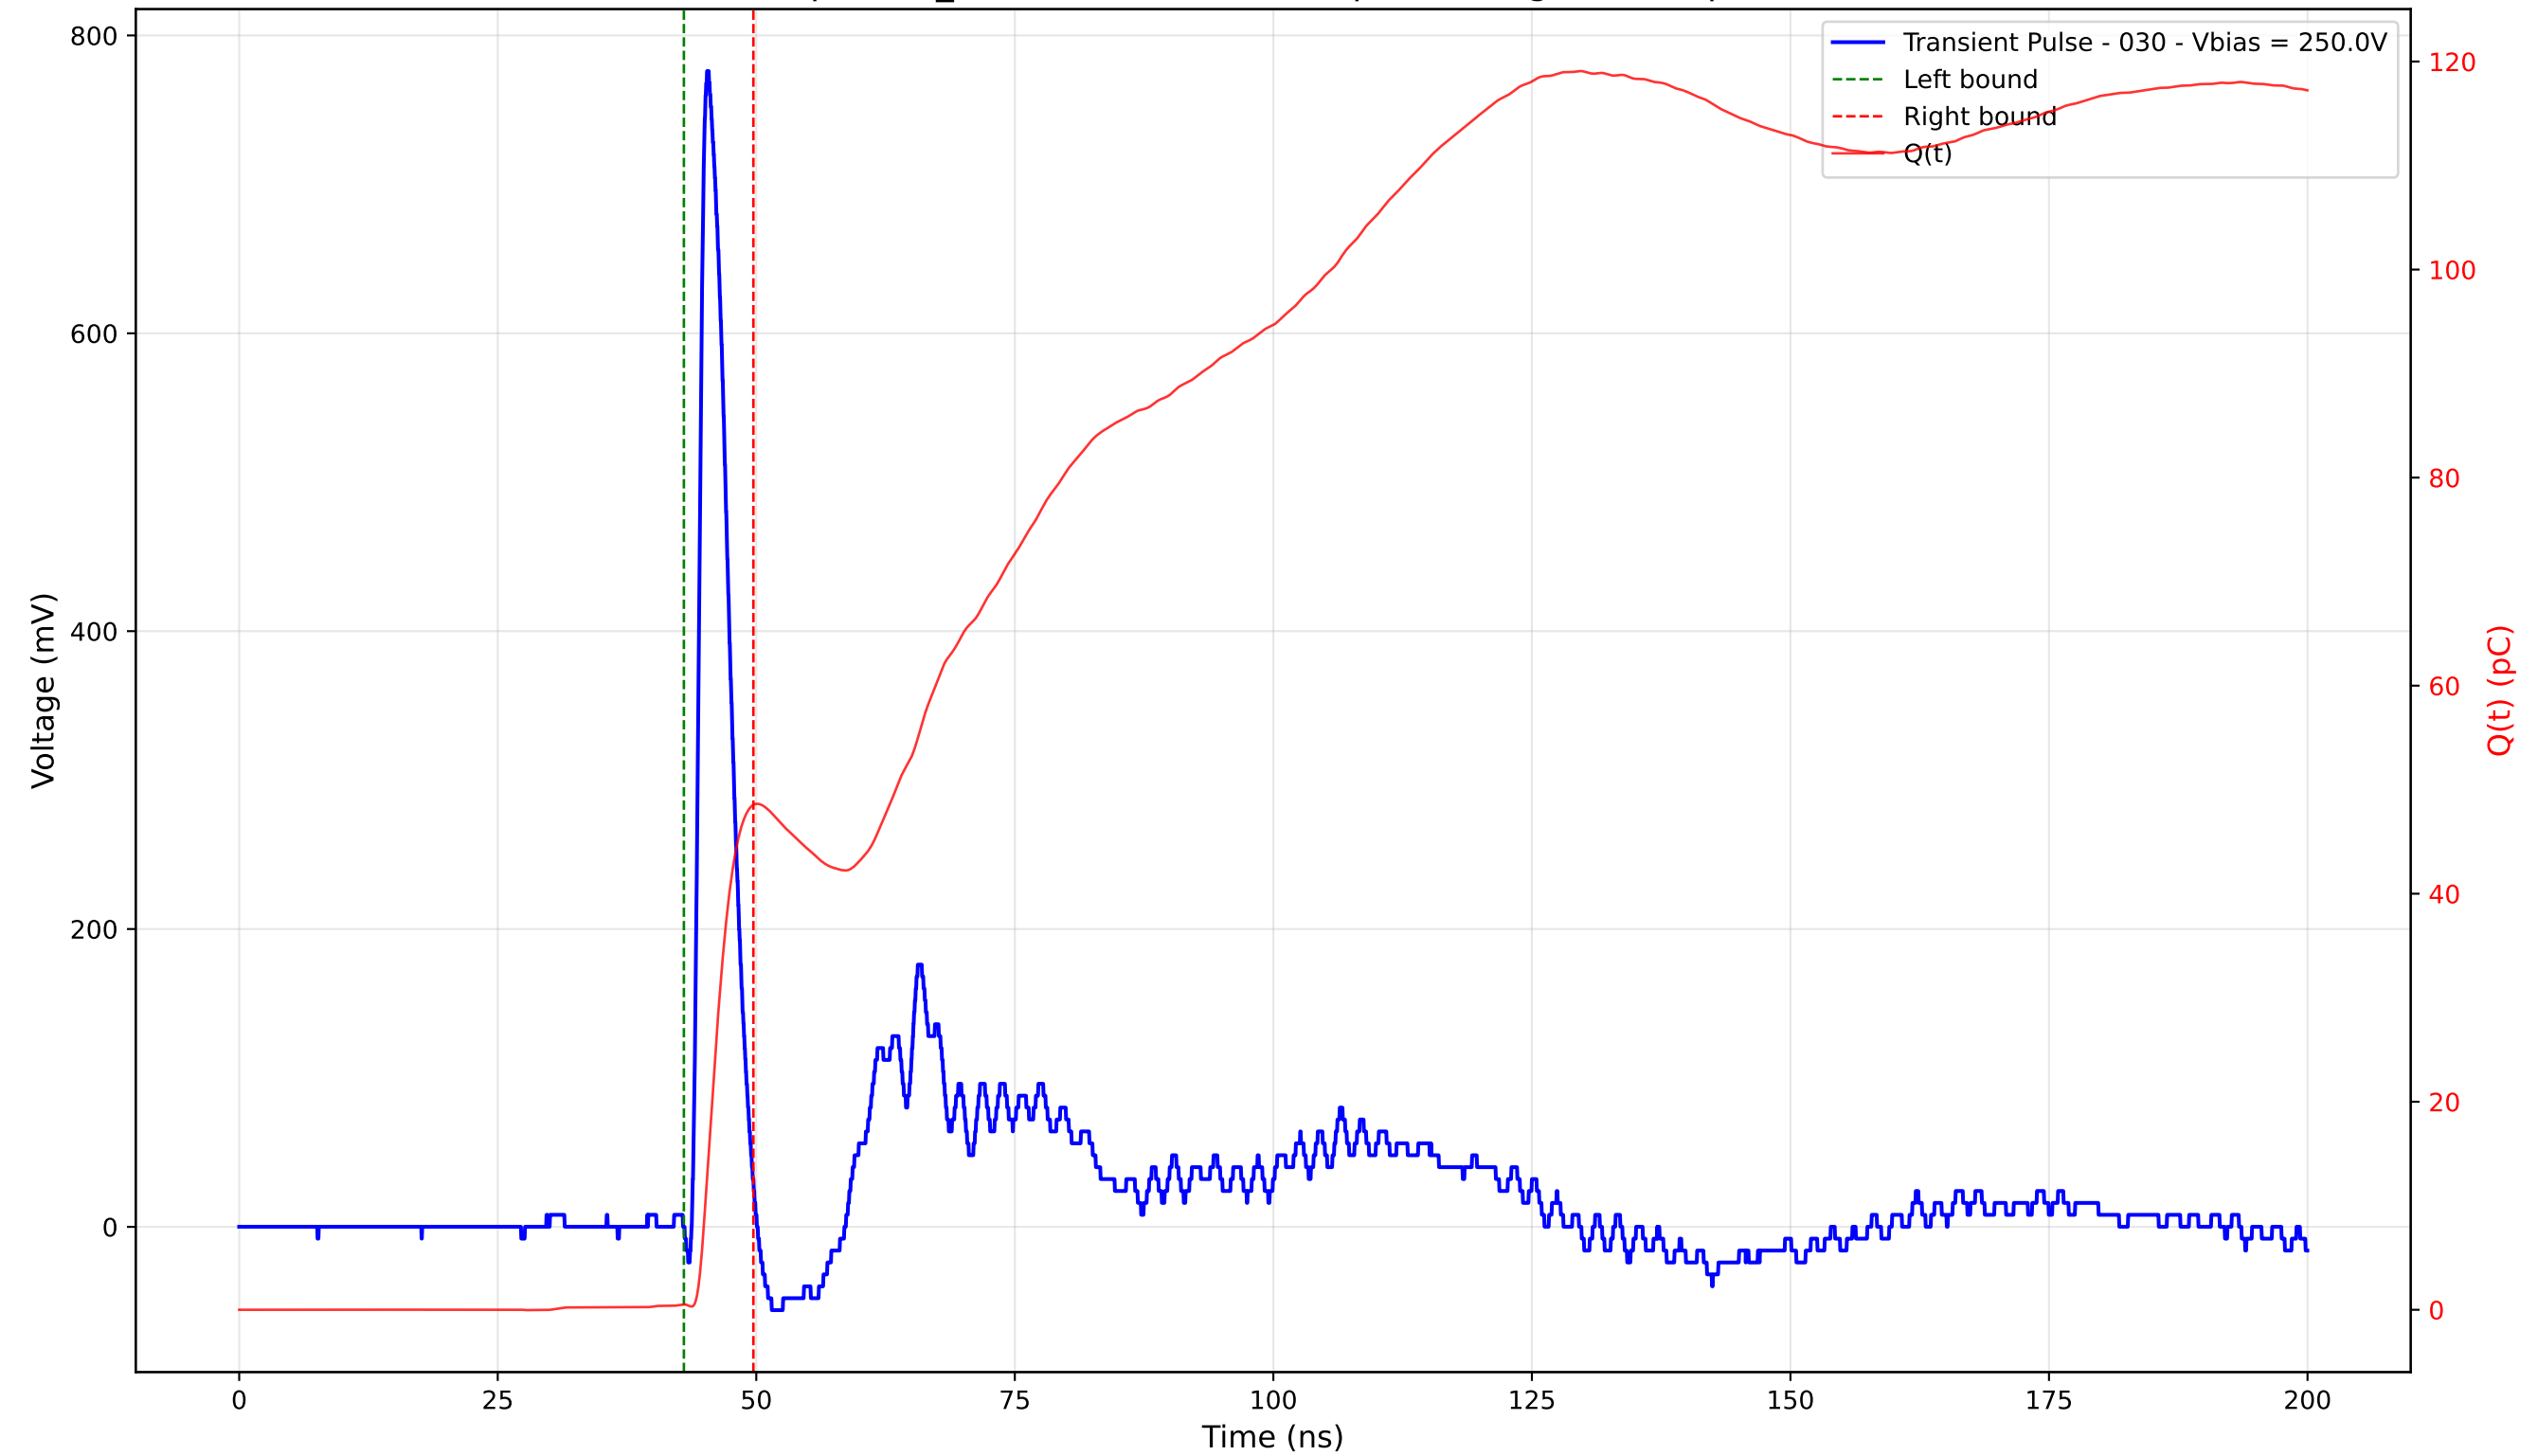


Transient Pulse - Sample: TD_4004 - Position: 210.0 μm - Charge: 47.54 pC - Rise Time: 0.90 ns

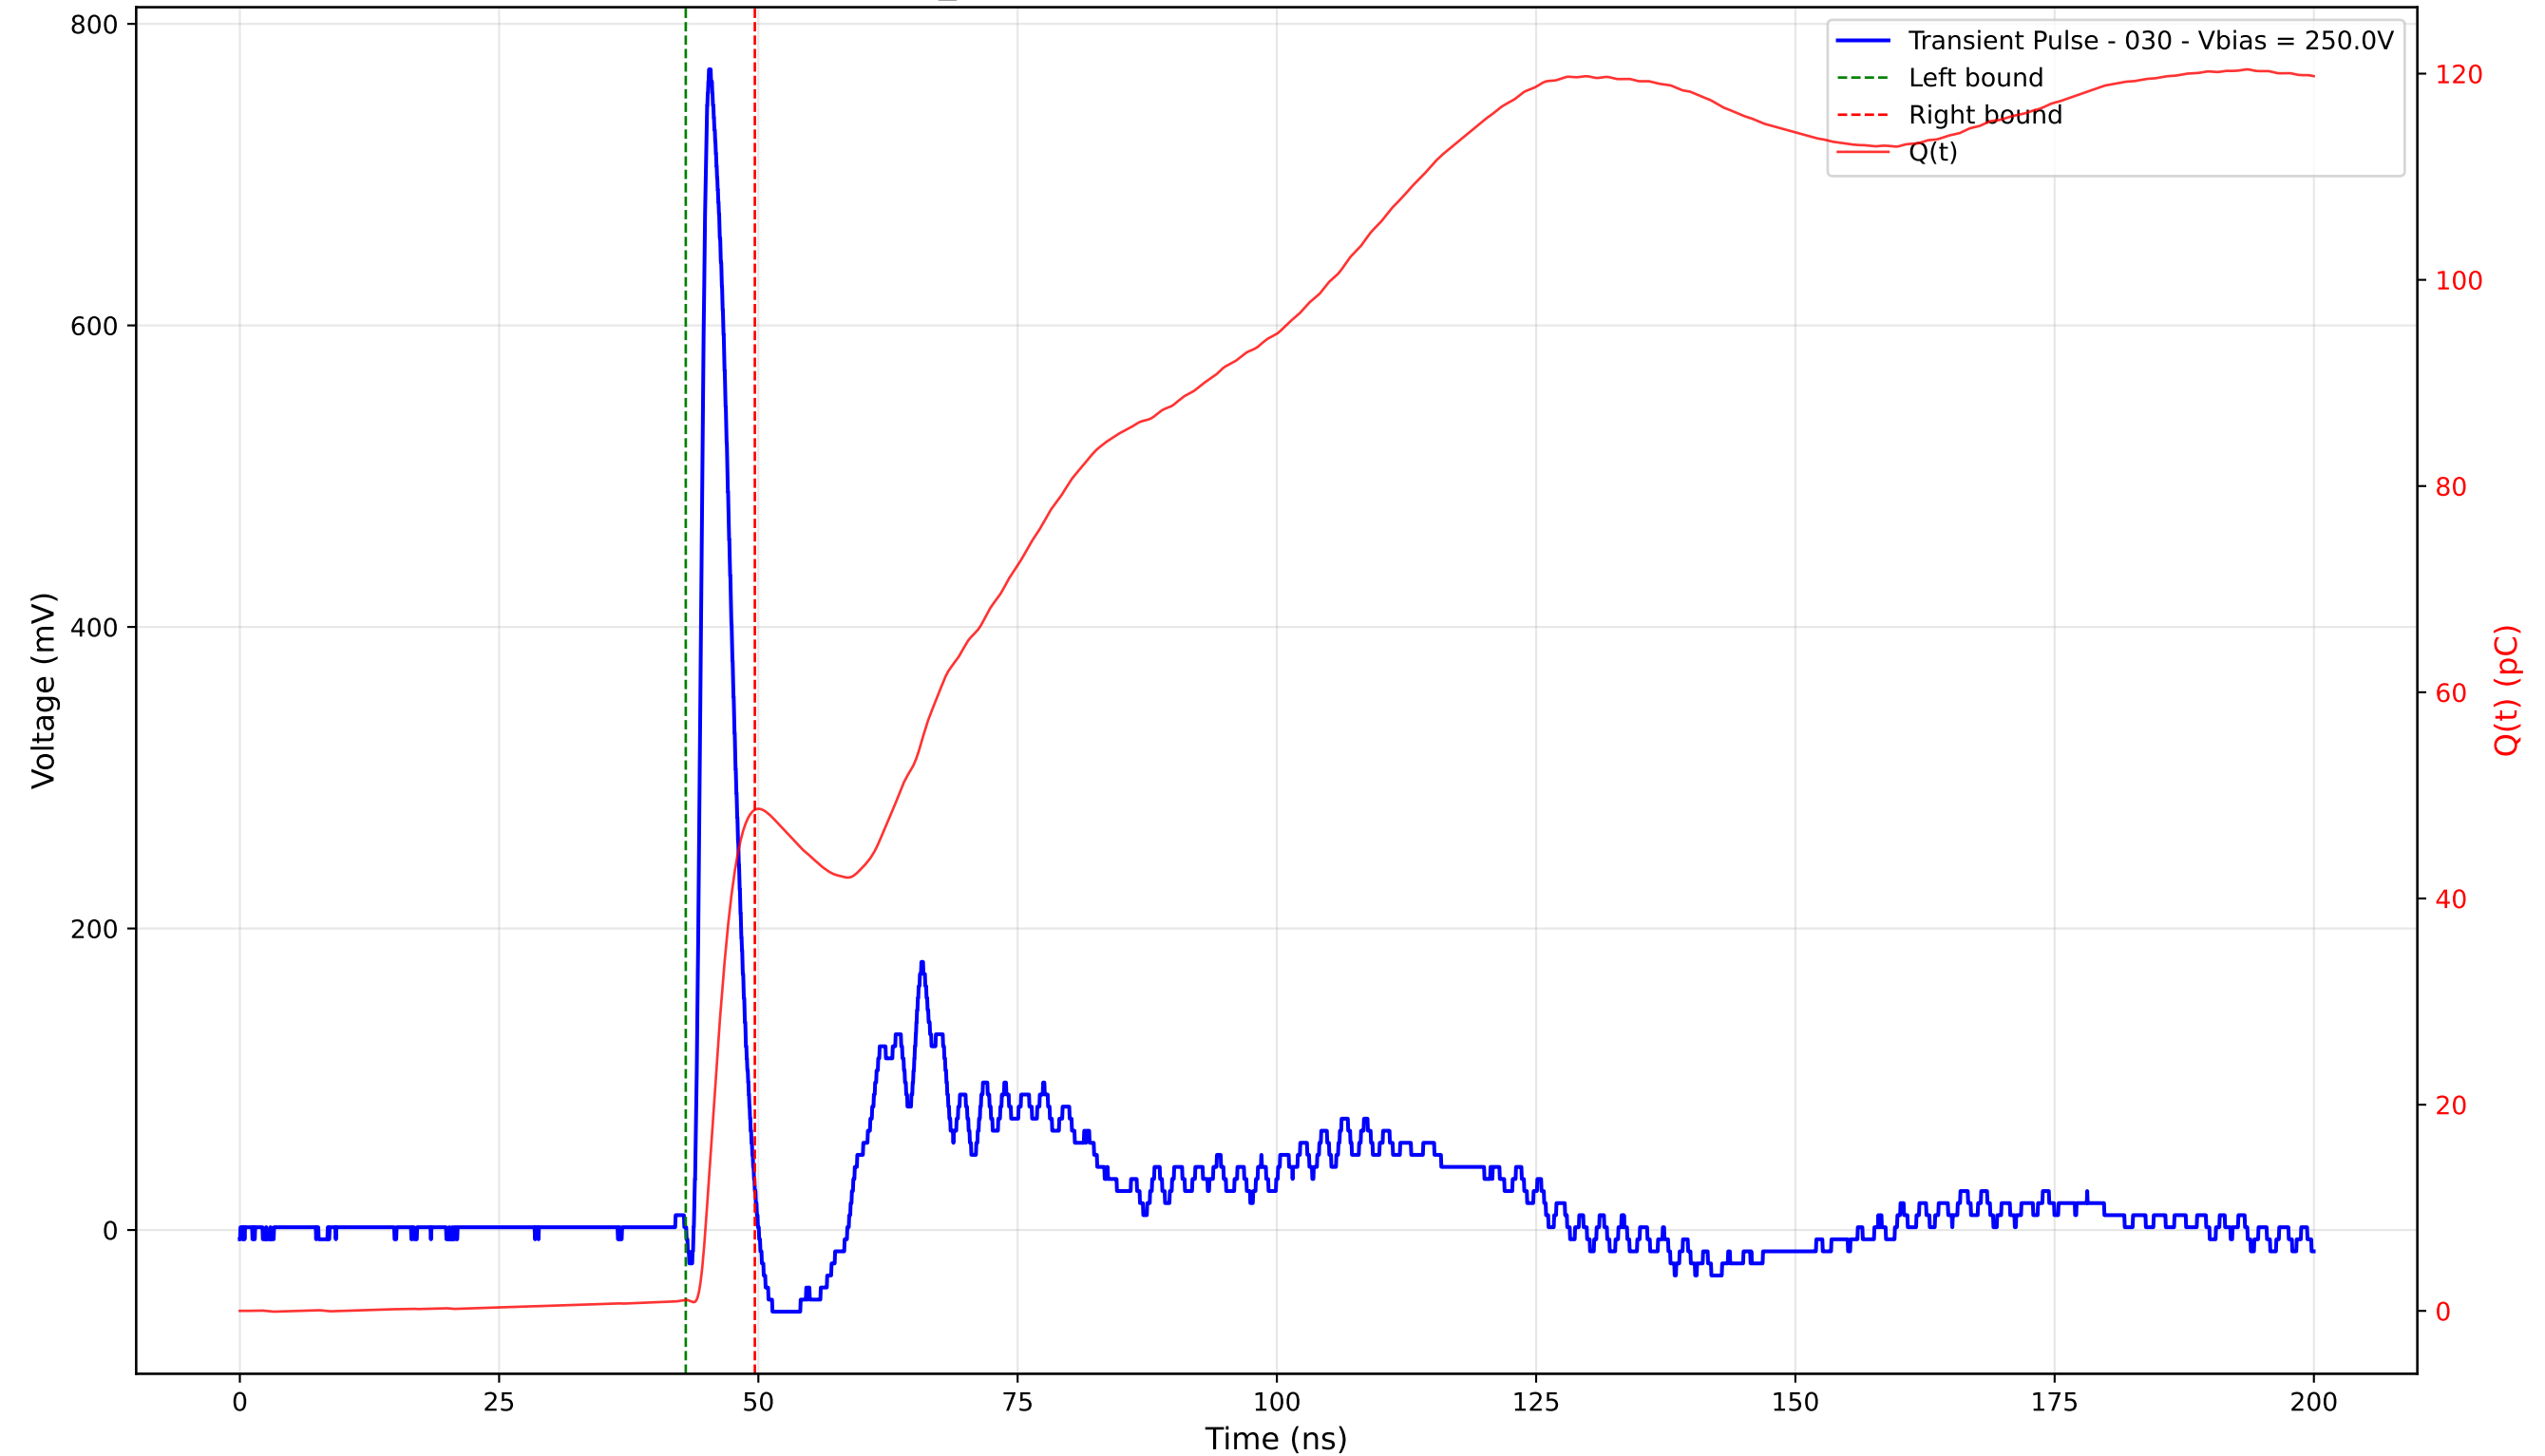


Transient Pulse - Sample: TD_4004 - Position: 215.0 μm - Charge: 47.50 pC - Rise Time: 0.92 ns

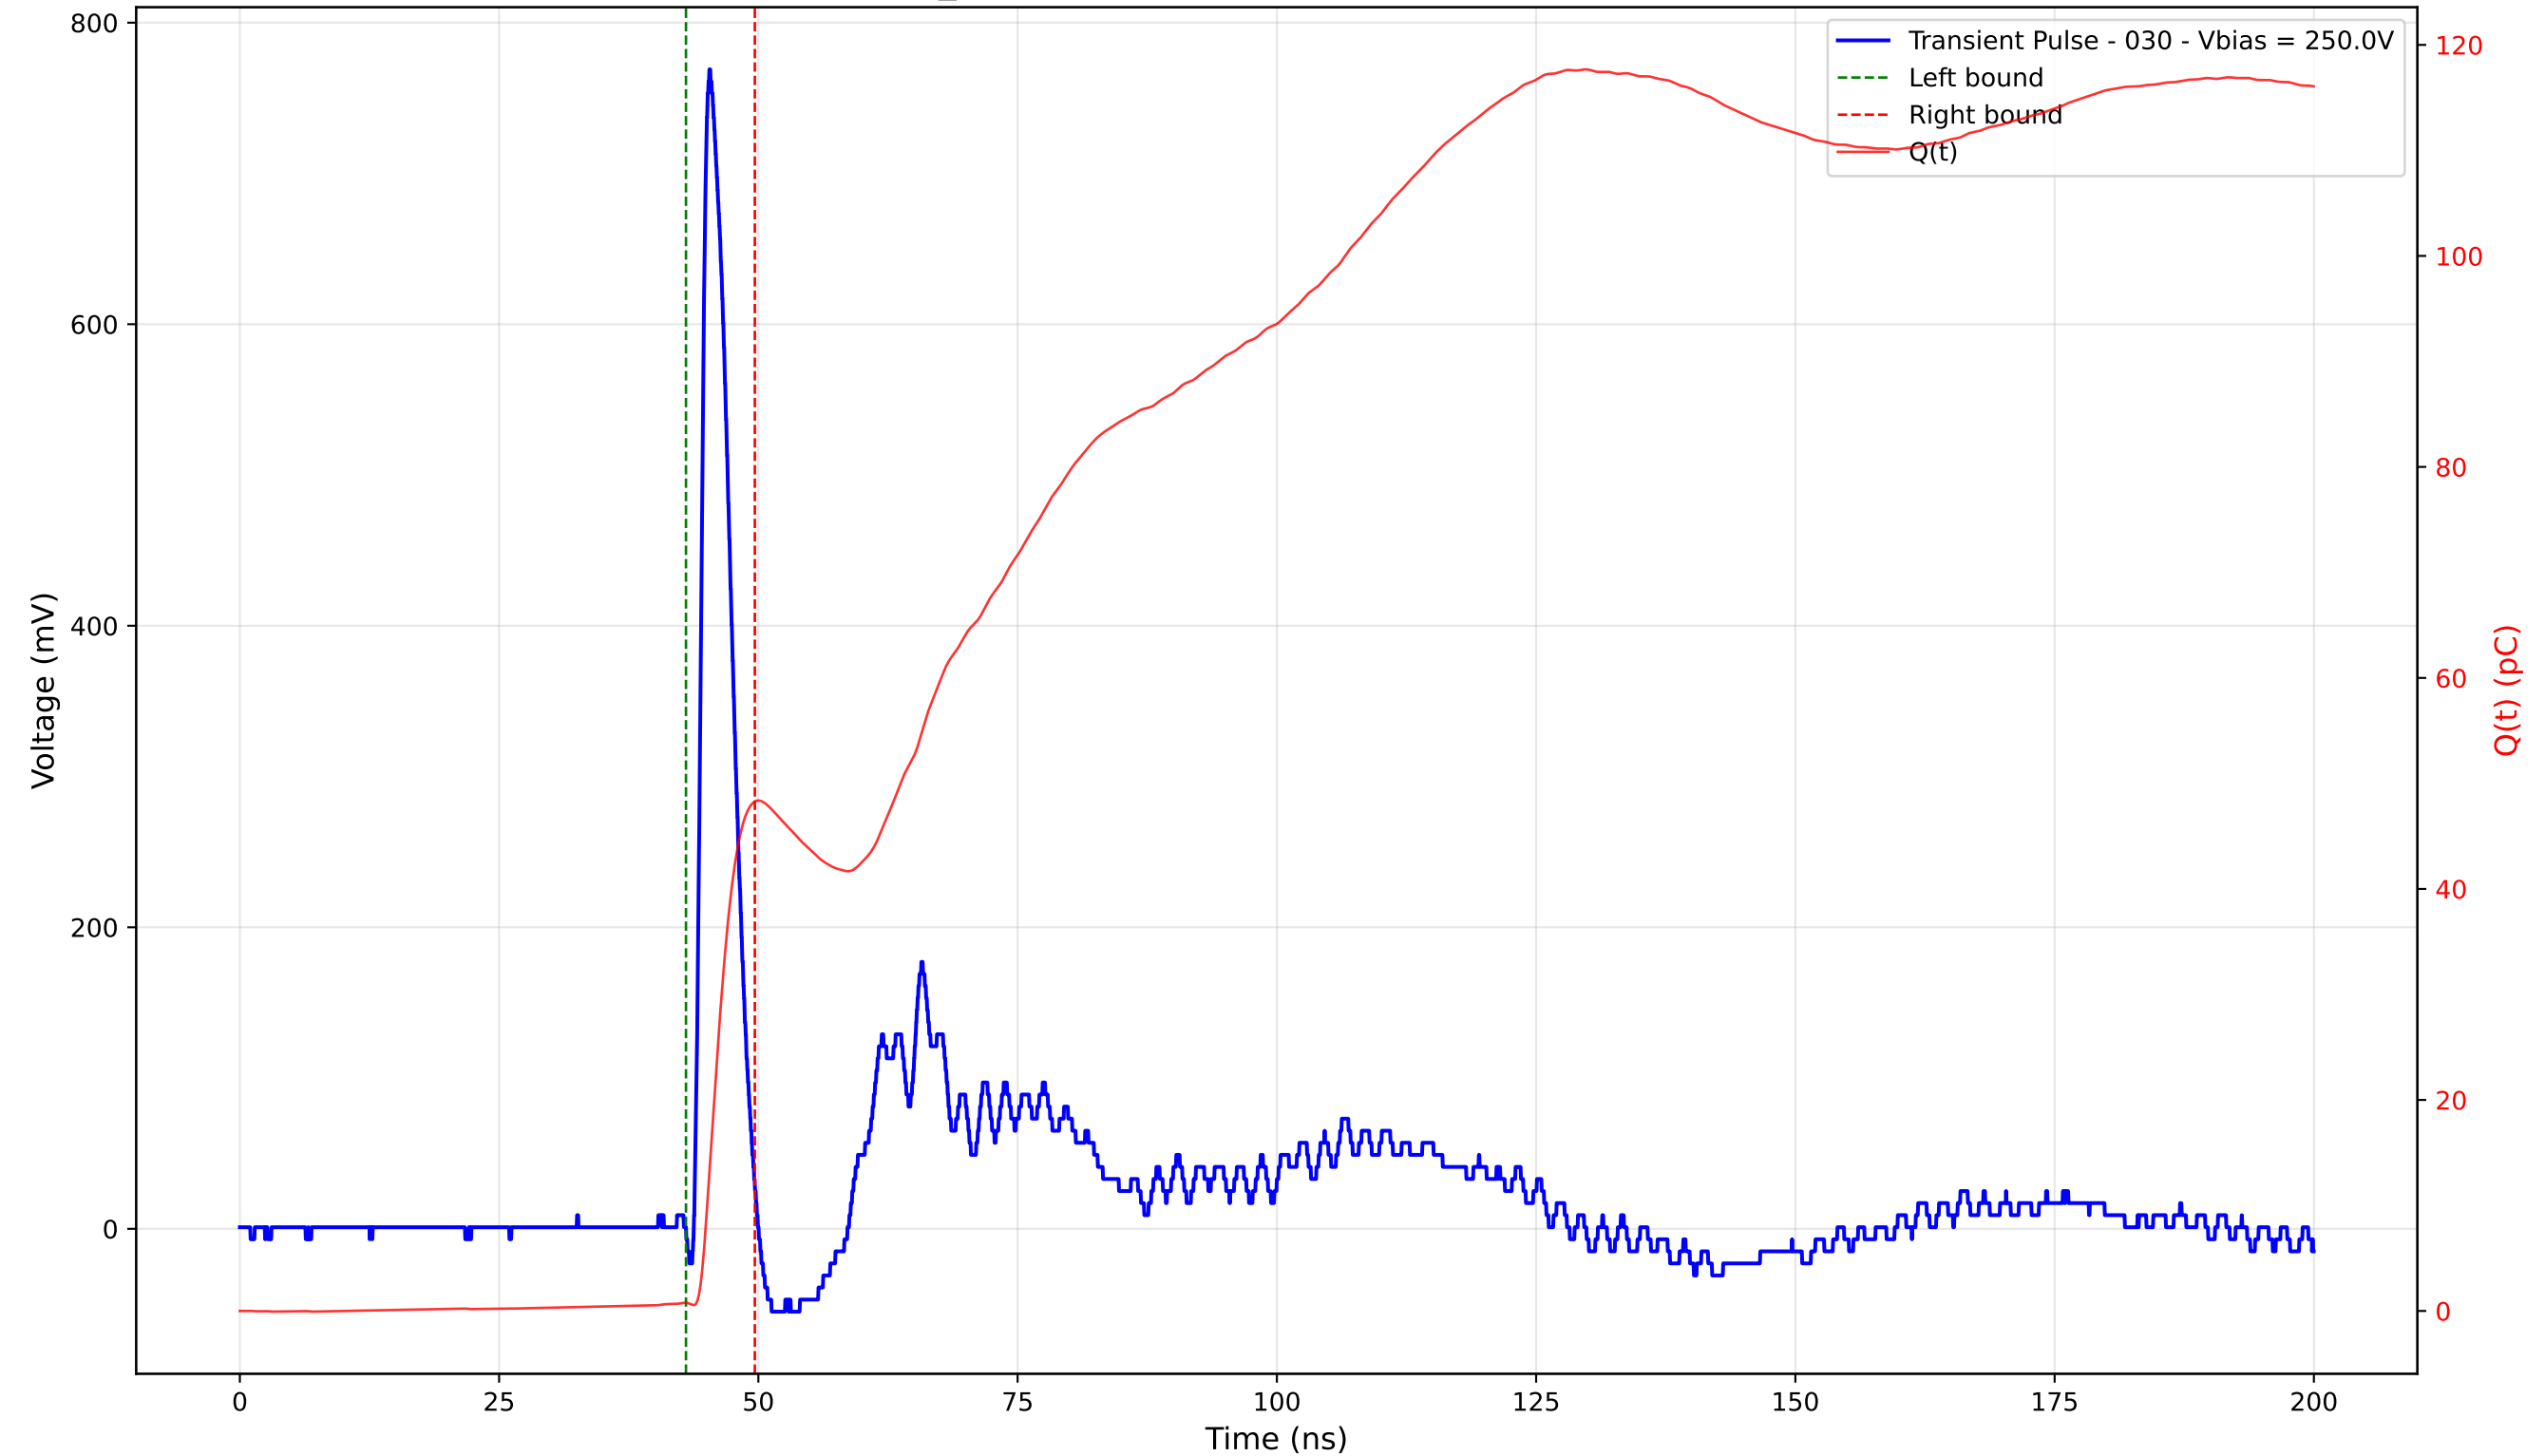


Transient Pulse - Sample: TD_4004 - Position: 220.0 μm - Charge: 47.30 pC - Rise Time: 0.90 ns

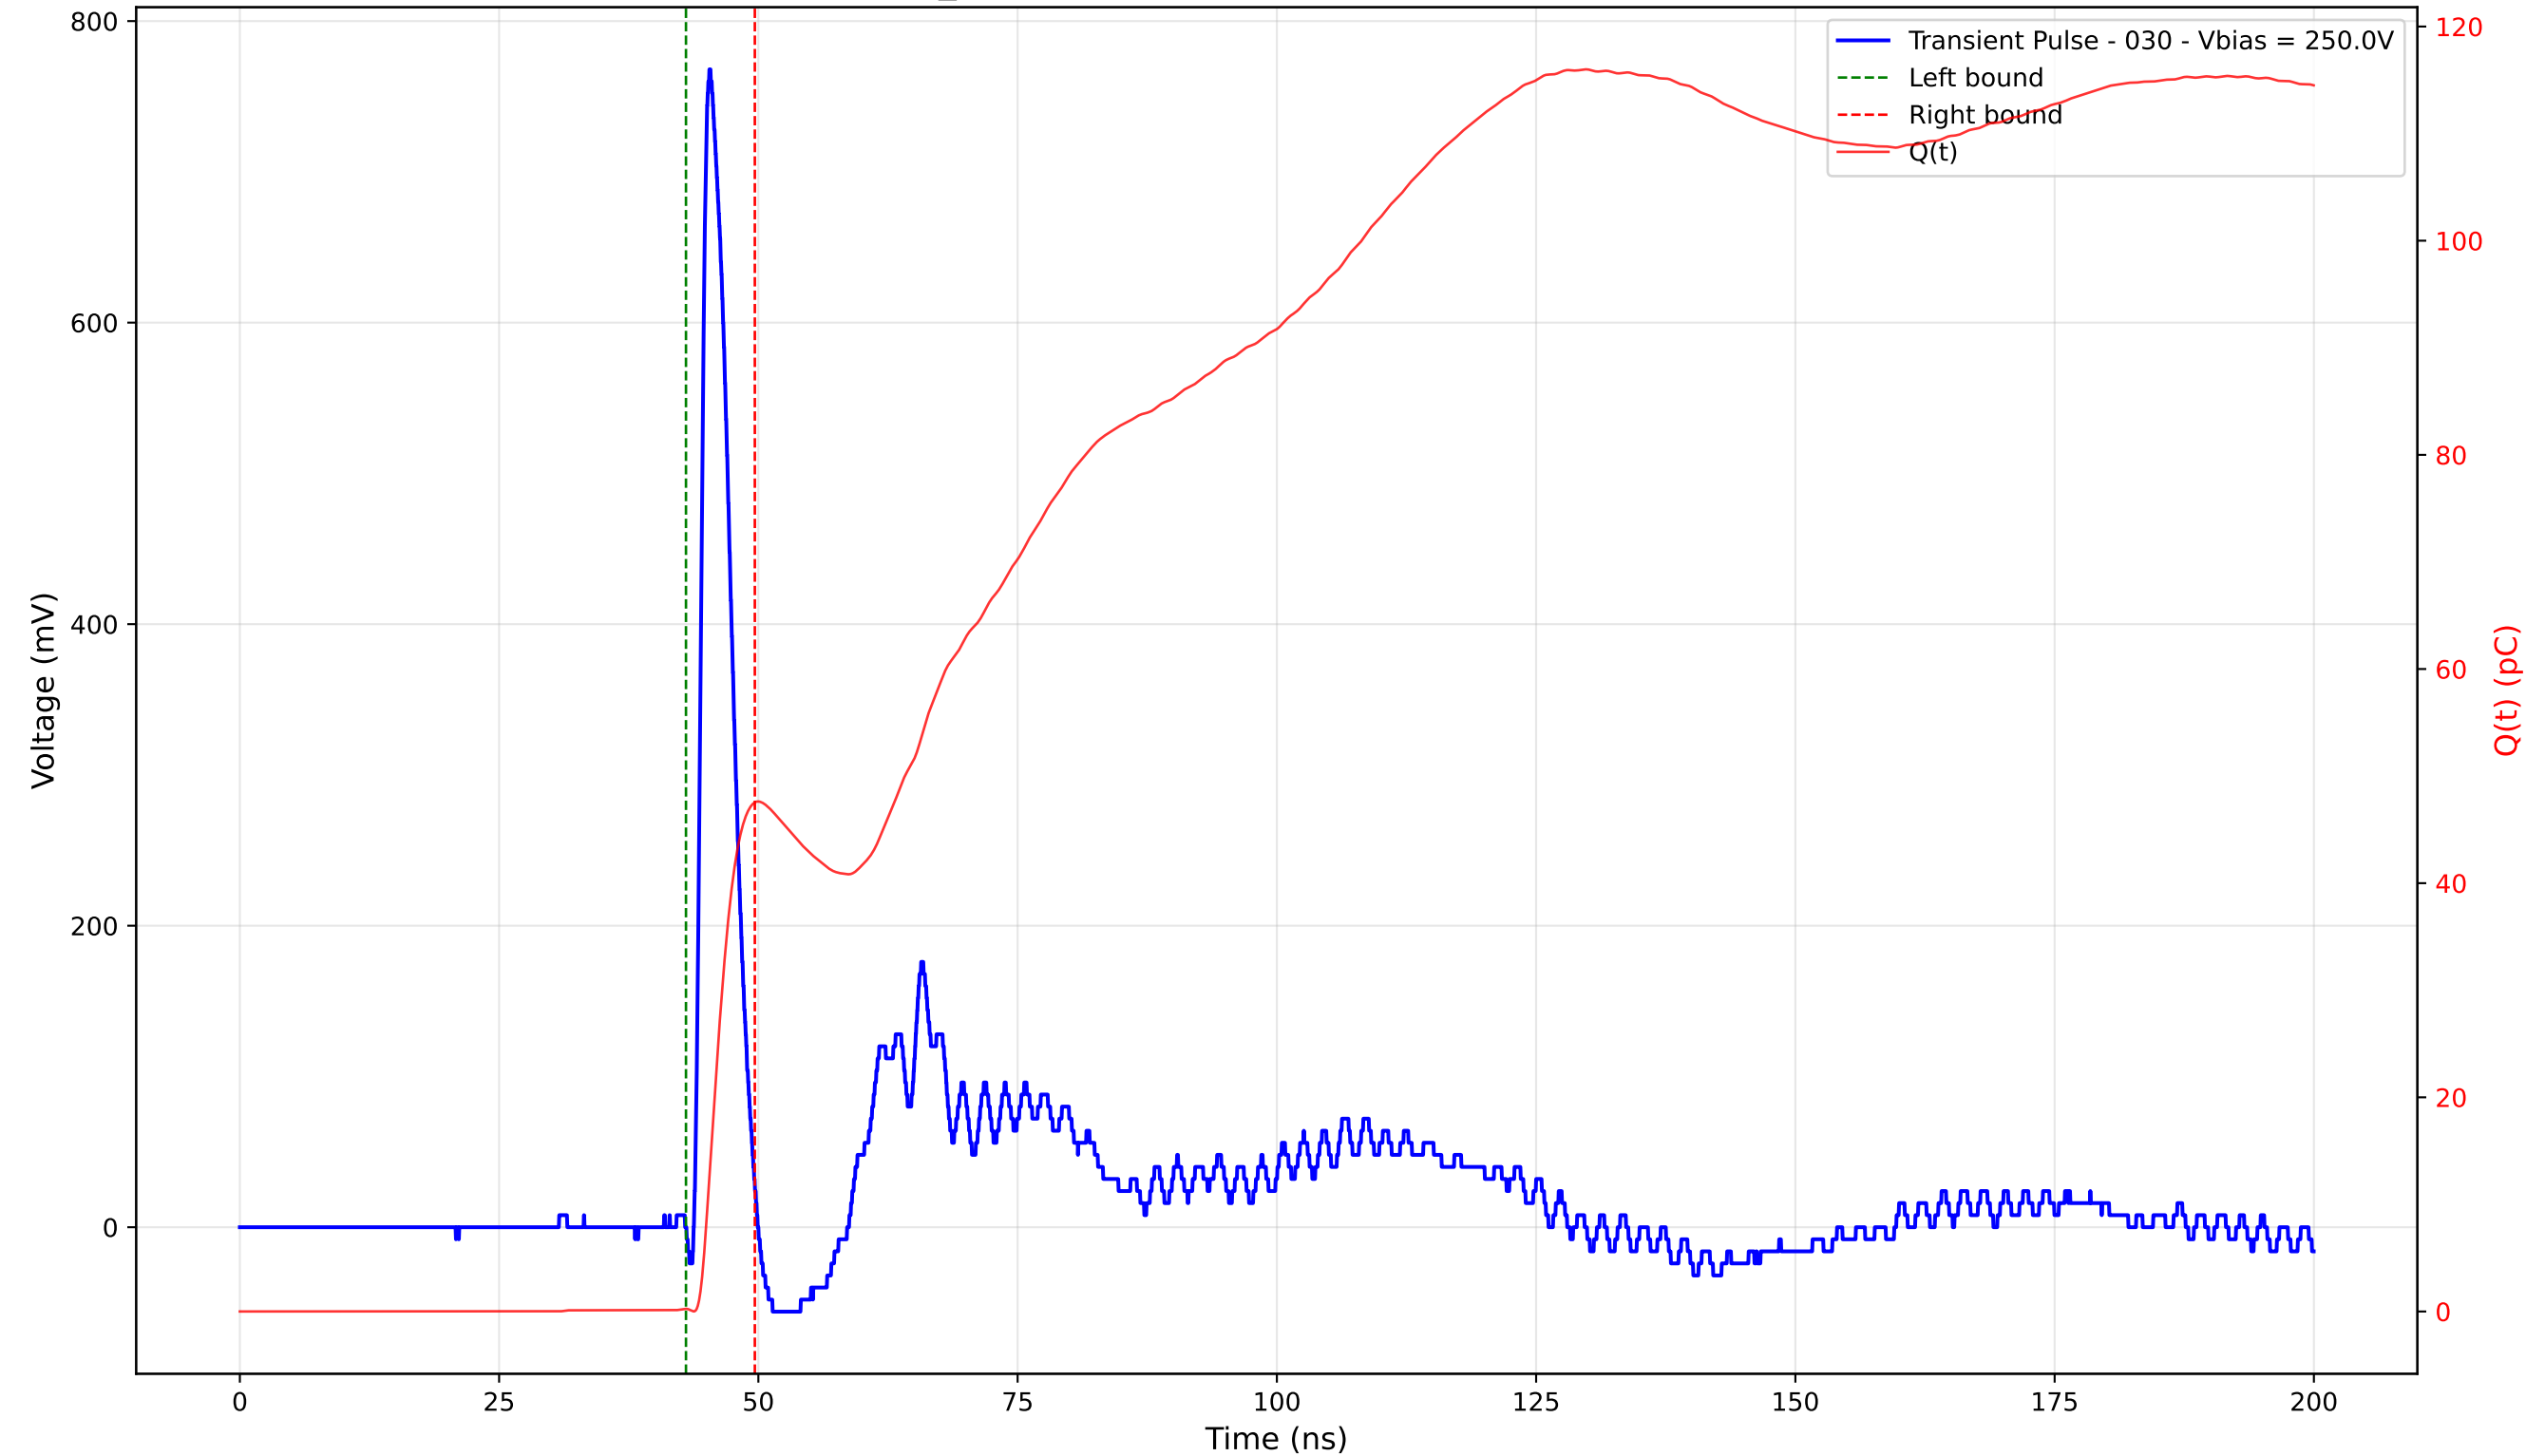


Transient Pulse - Sample: TD_4004 - Position: 225.0 μm - Charge: 47.32 pC - Rise Time: 0.92 ns

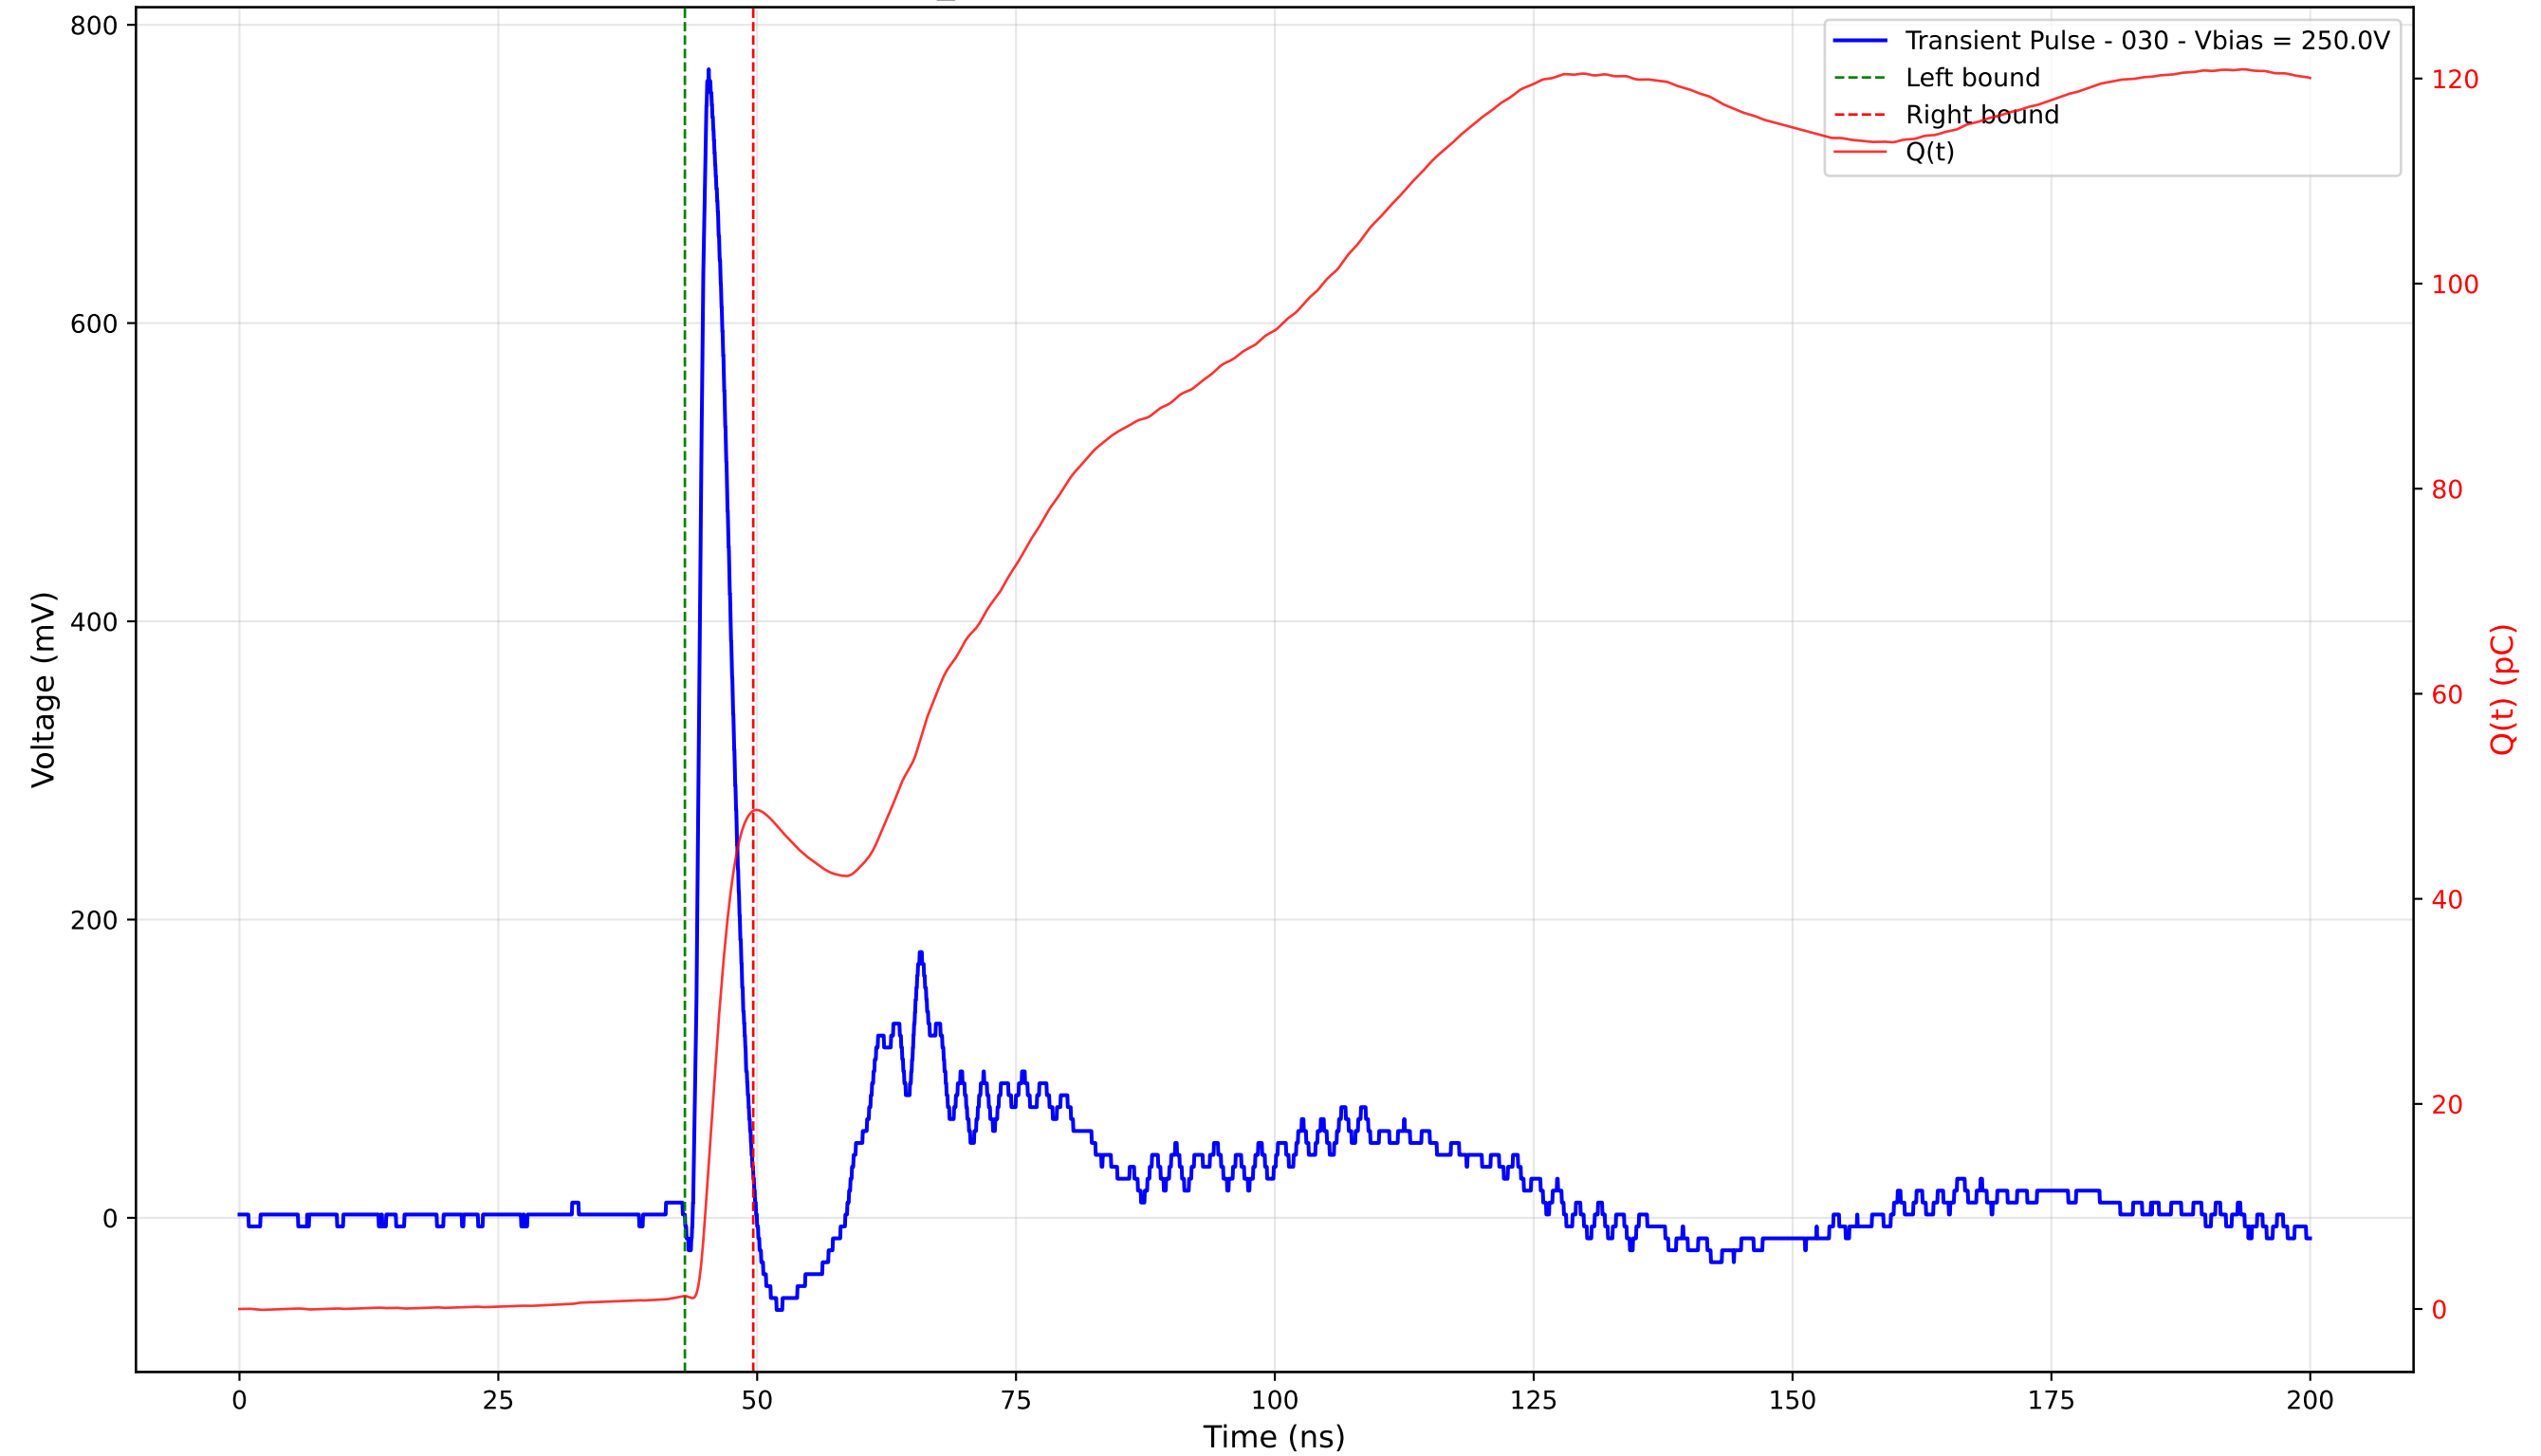


Transient Pulse - Sample: TD_4004 - Position: 230.0 μm - Charge: 46.23 pC - Rise Time: 0.93 ns

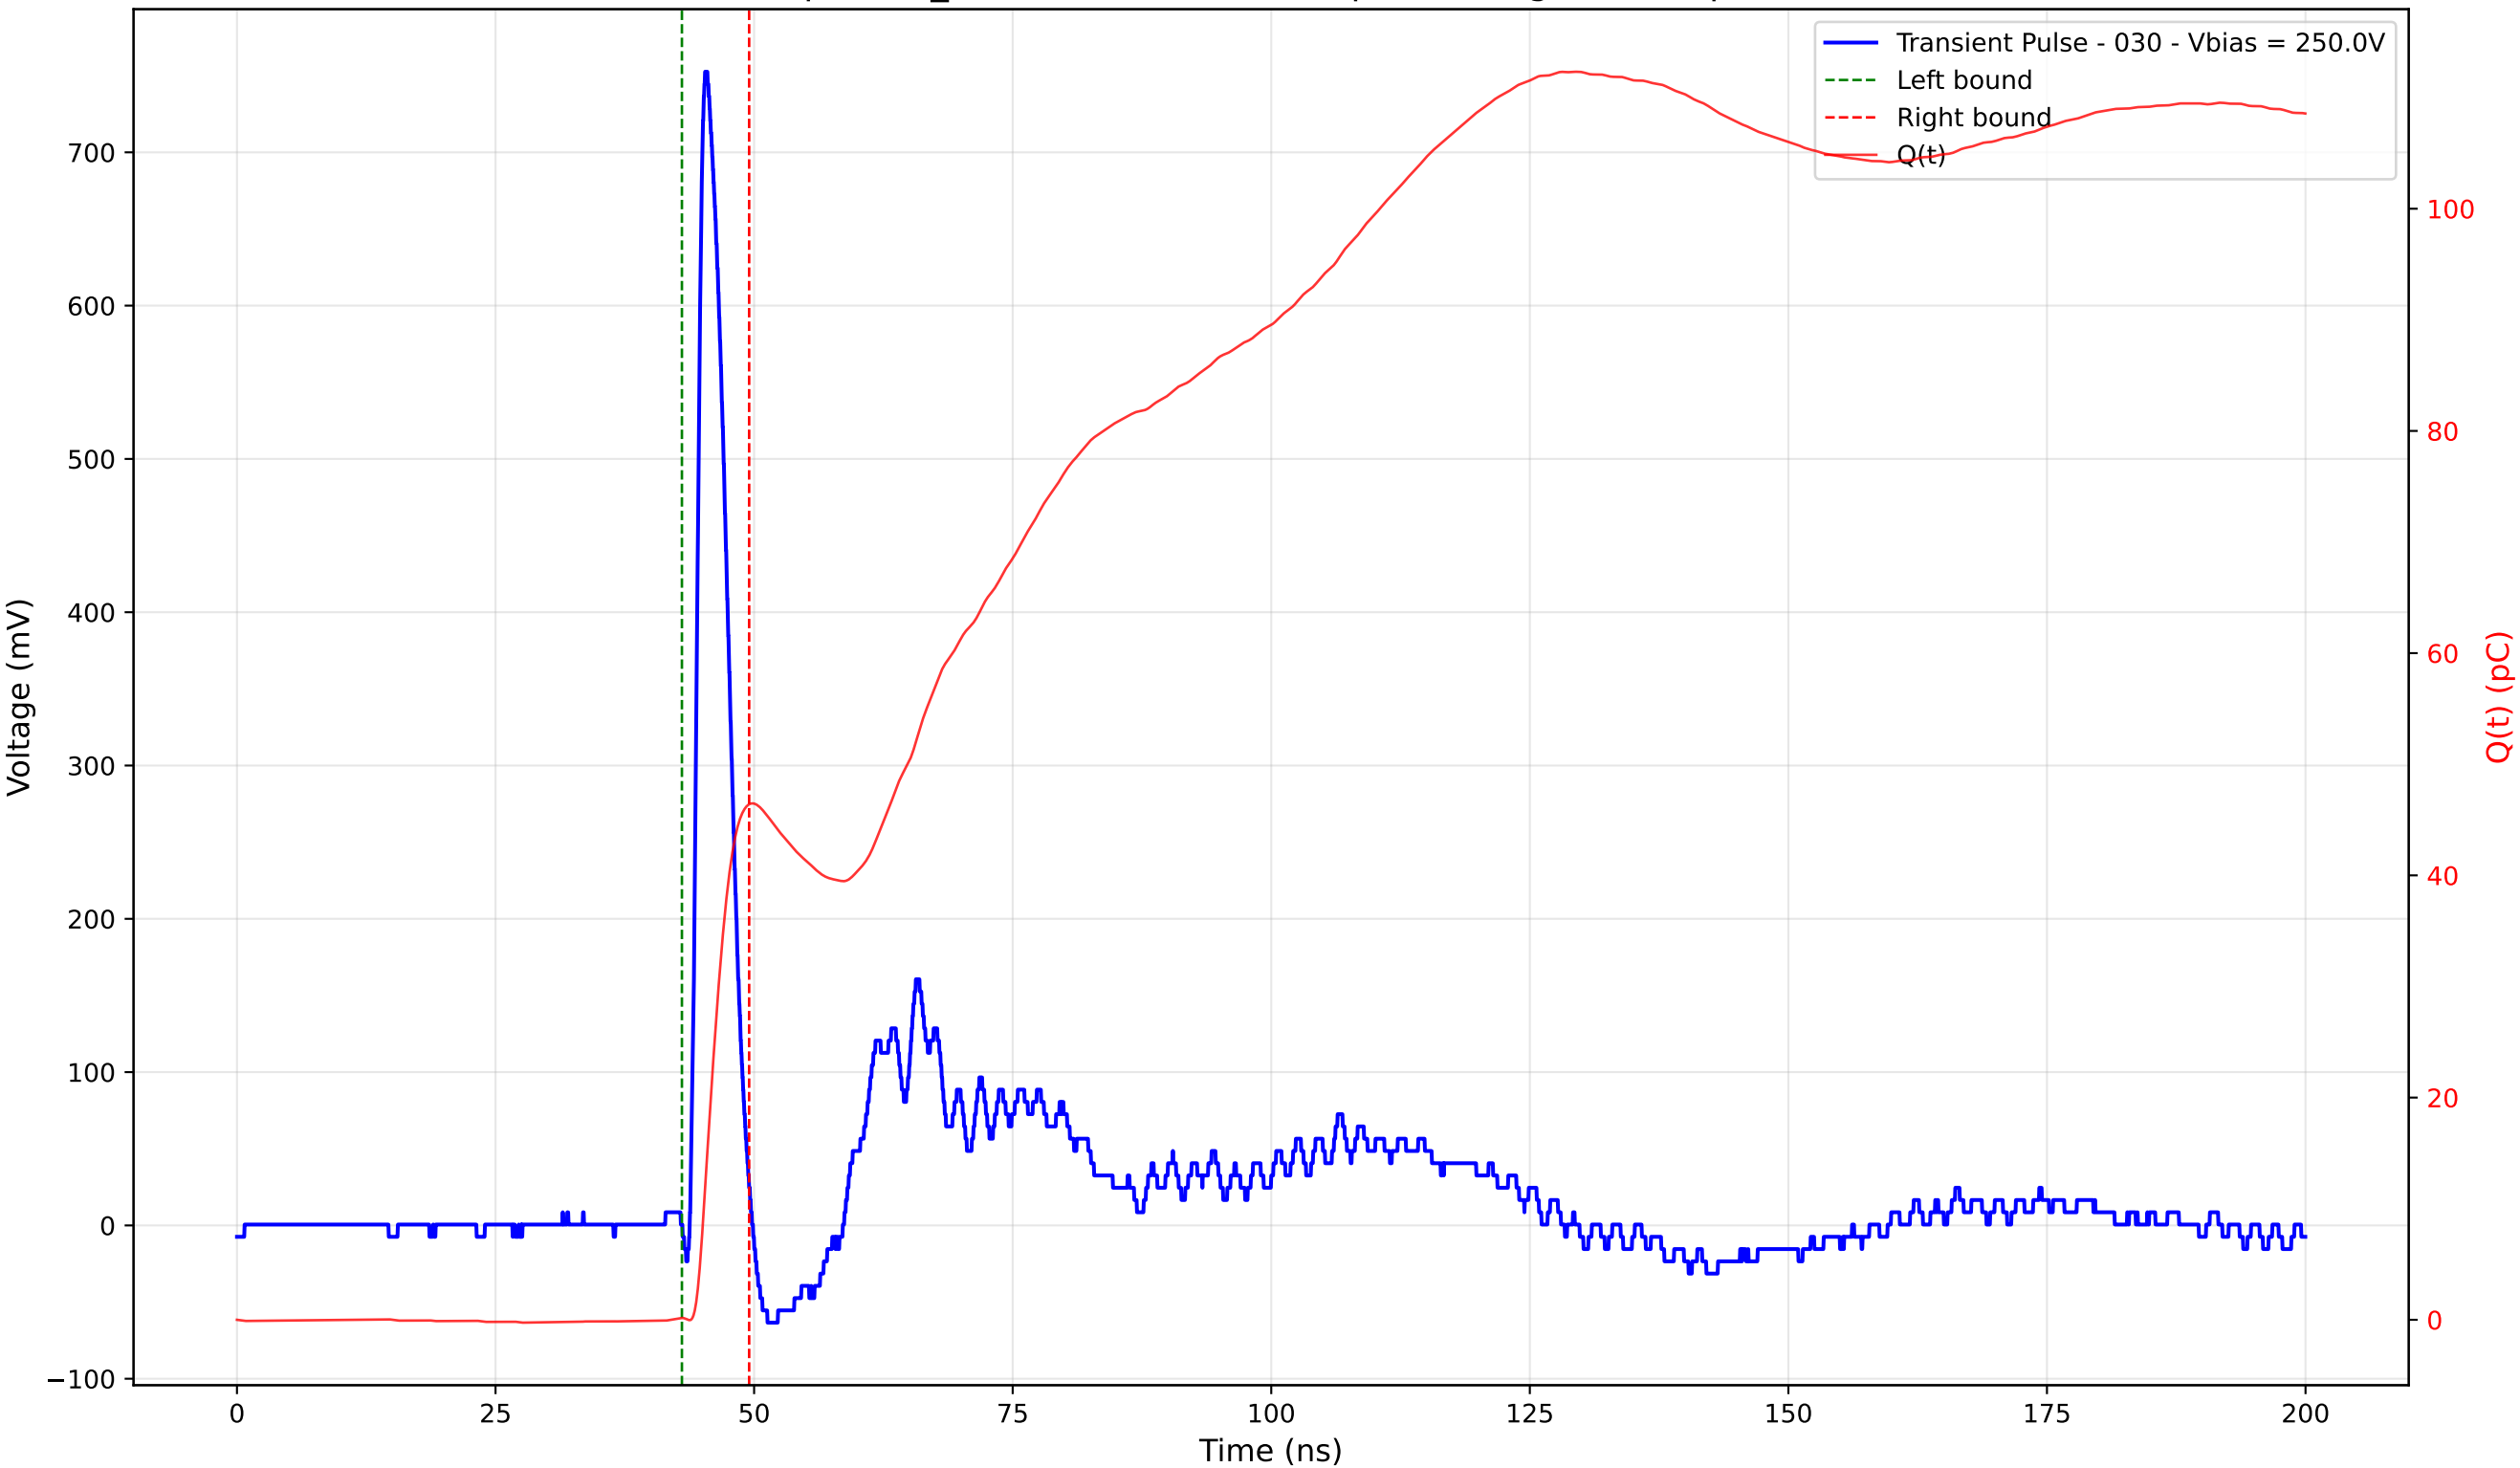


Transient Pulse - Sample: TD_4004 - Position: 235.0 μm - Charge: 44.92 pC - Rise Time: 0.93 ns

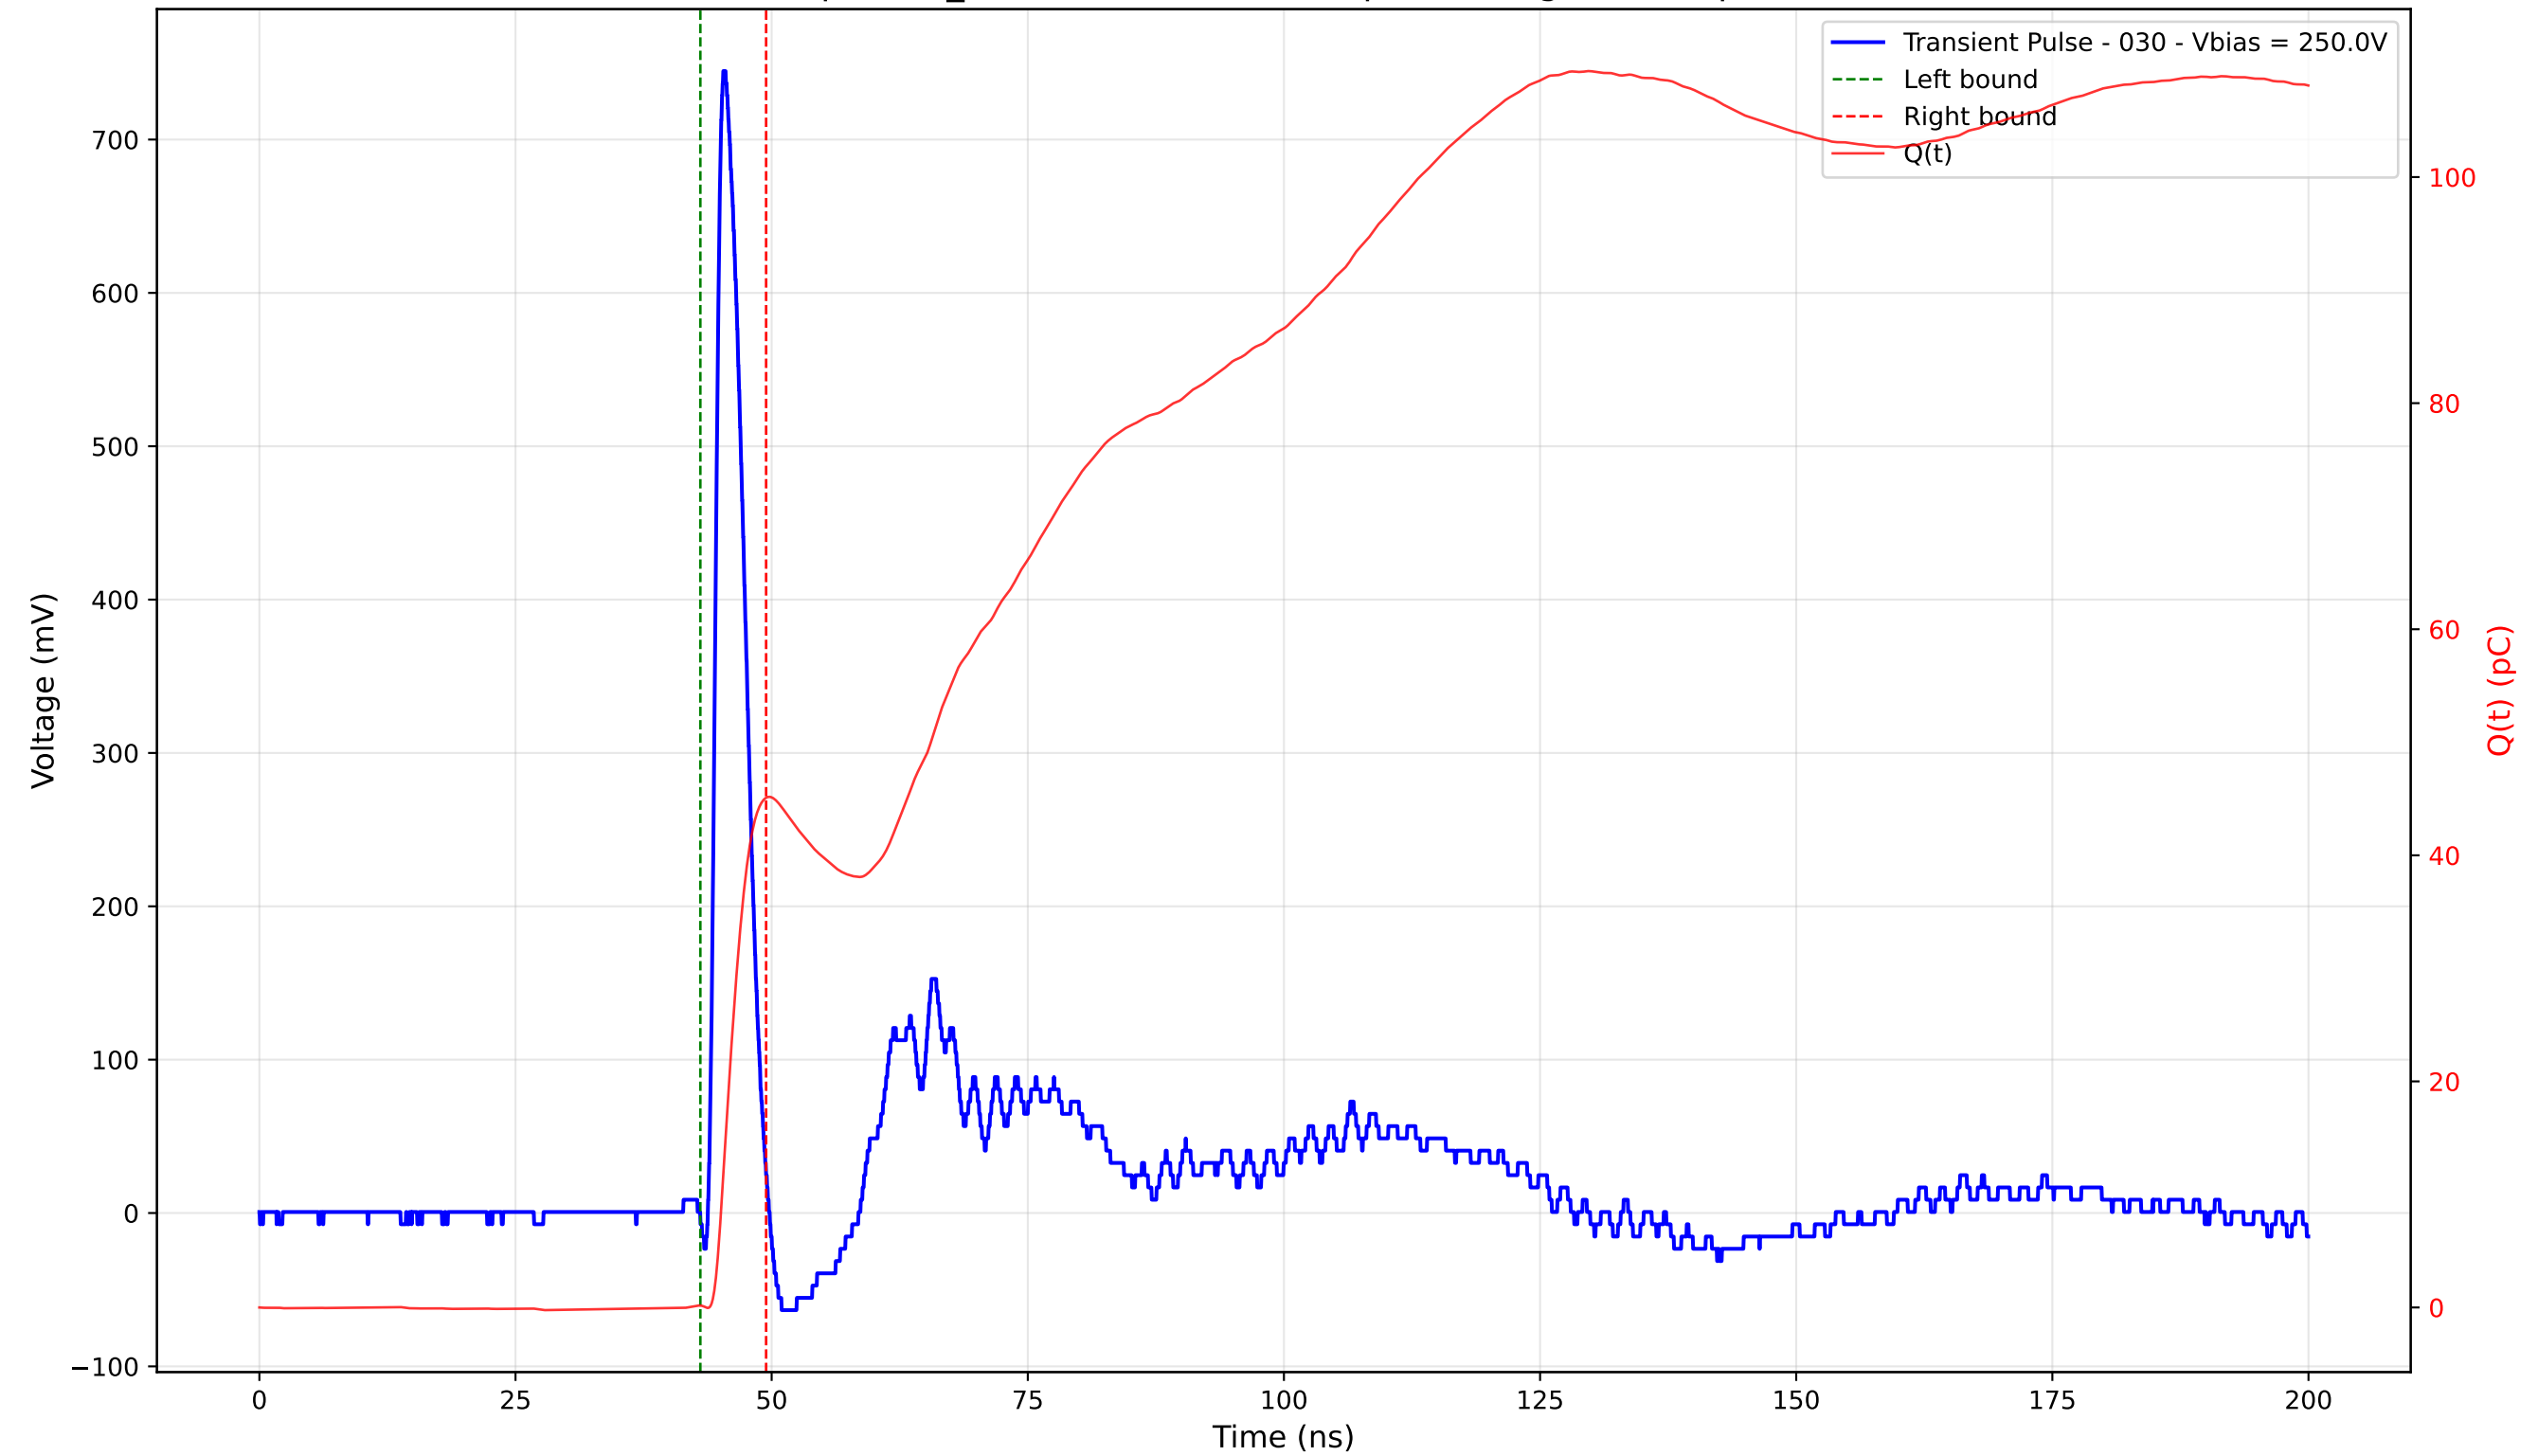


Transient Pulse - Sample: TD_4004 - Position: 240.0 μm - Charge: 44.32 pC - Rise Time: 0.92 ns

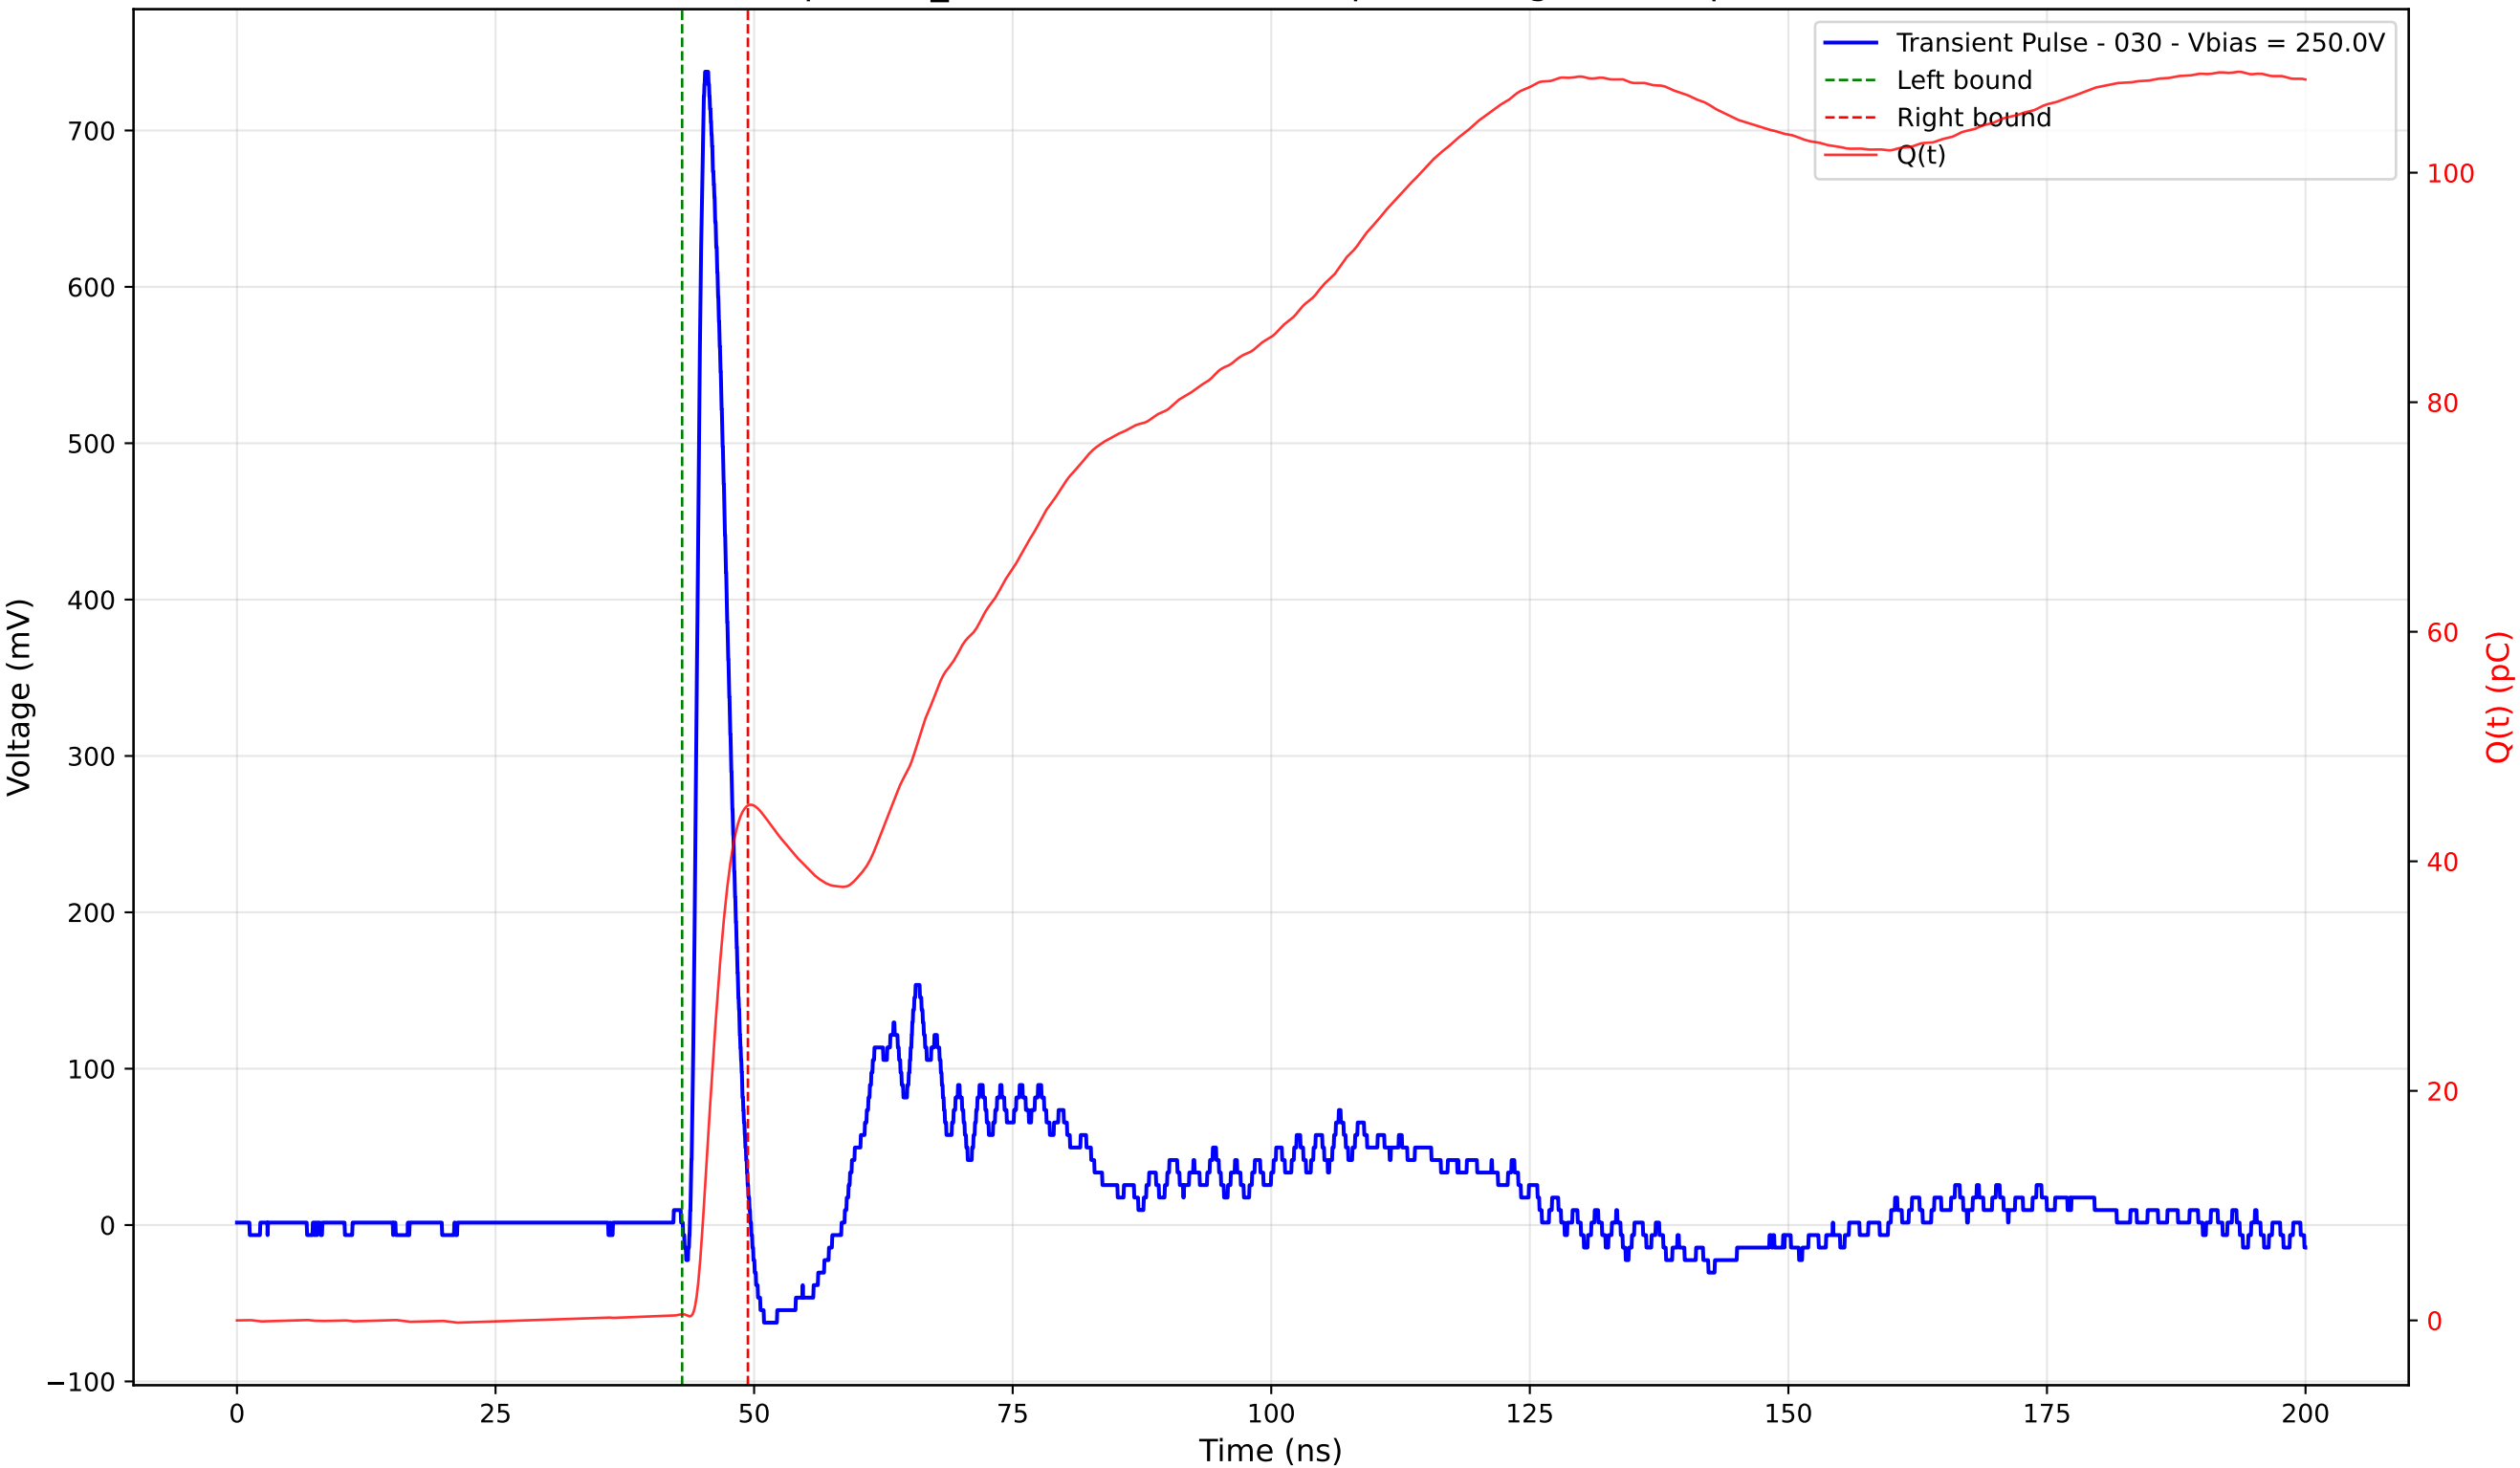


Transient Pulse - Sample: TD_4004 - Position: 245.0 μm - Charge: 44.85 pC - Rise Time: 0.93 ns

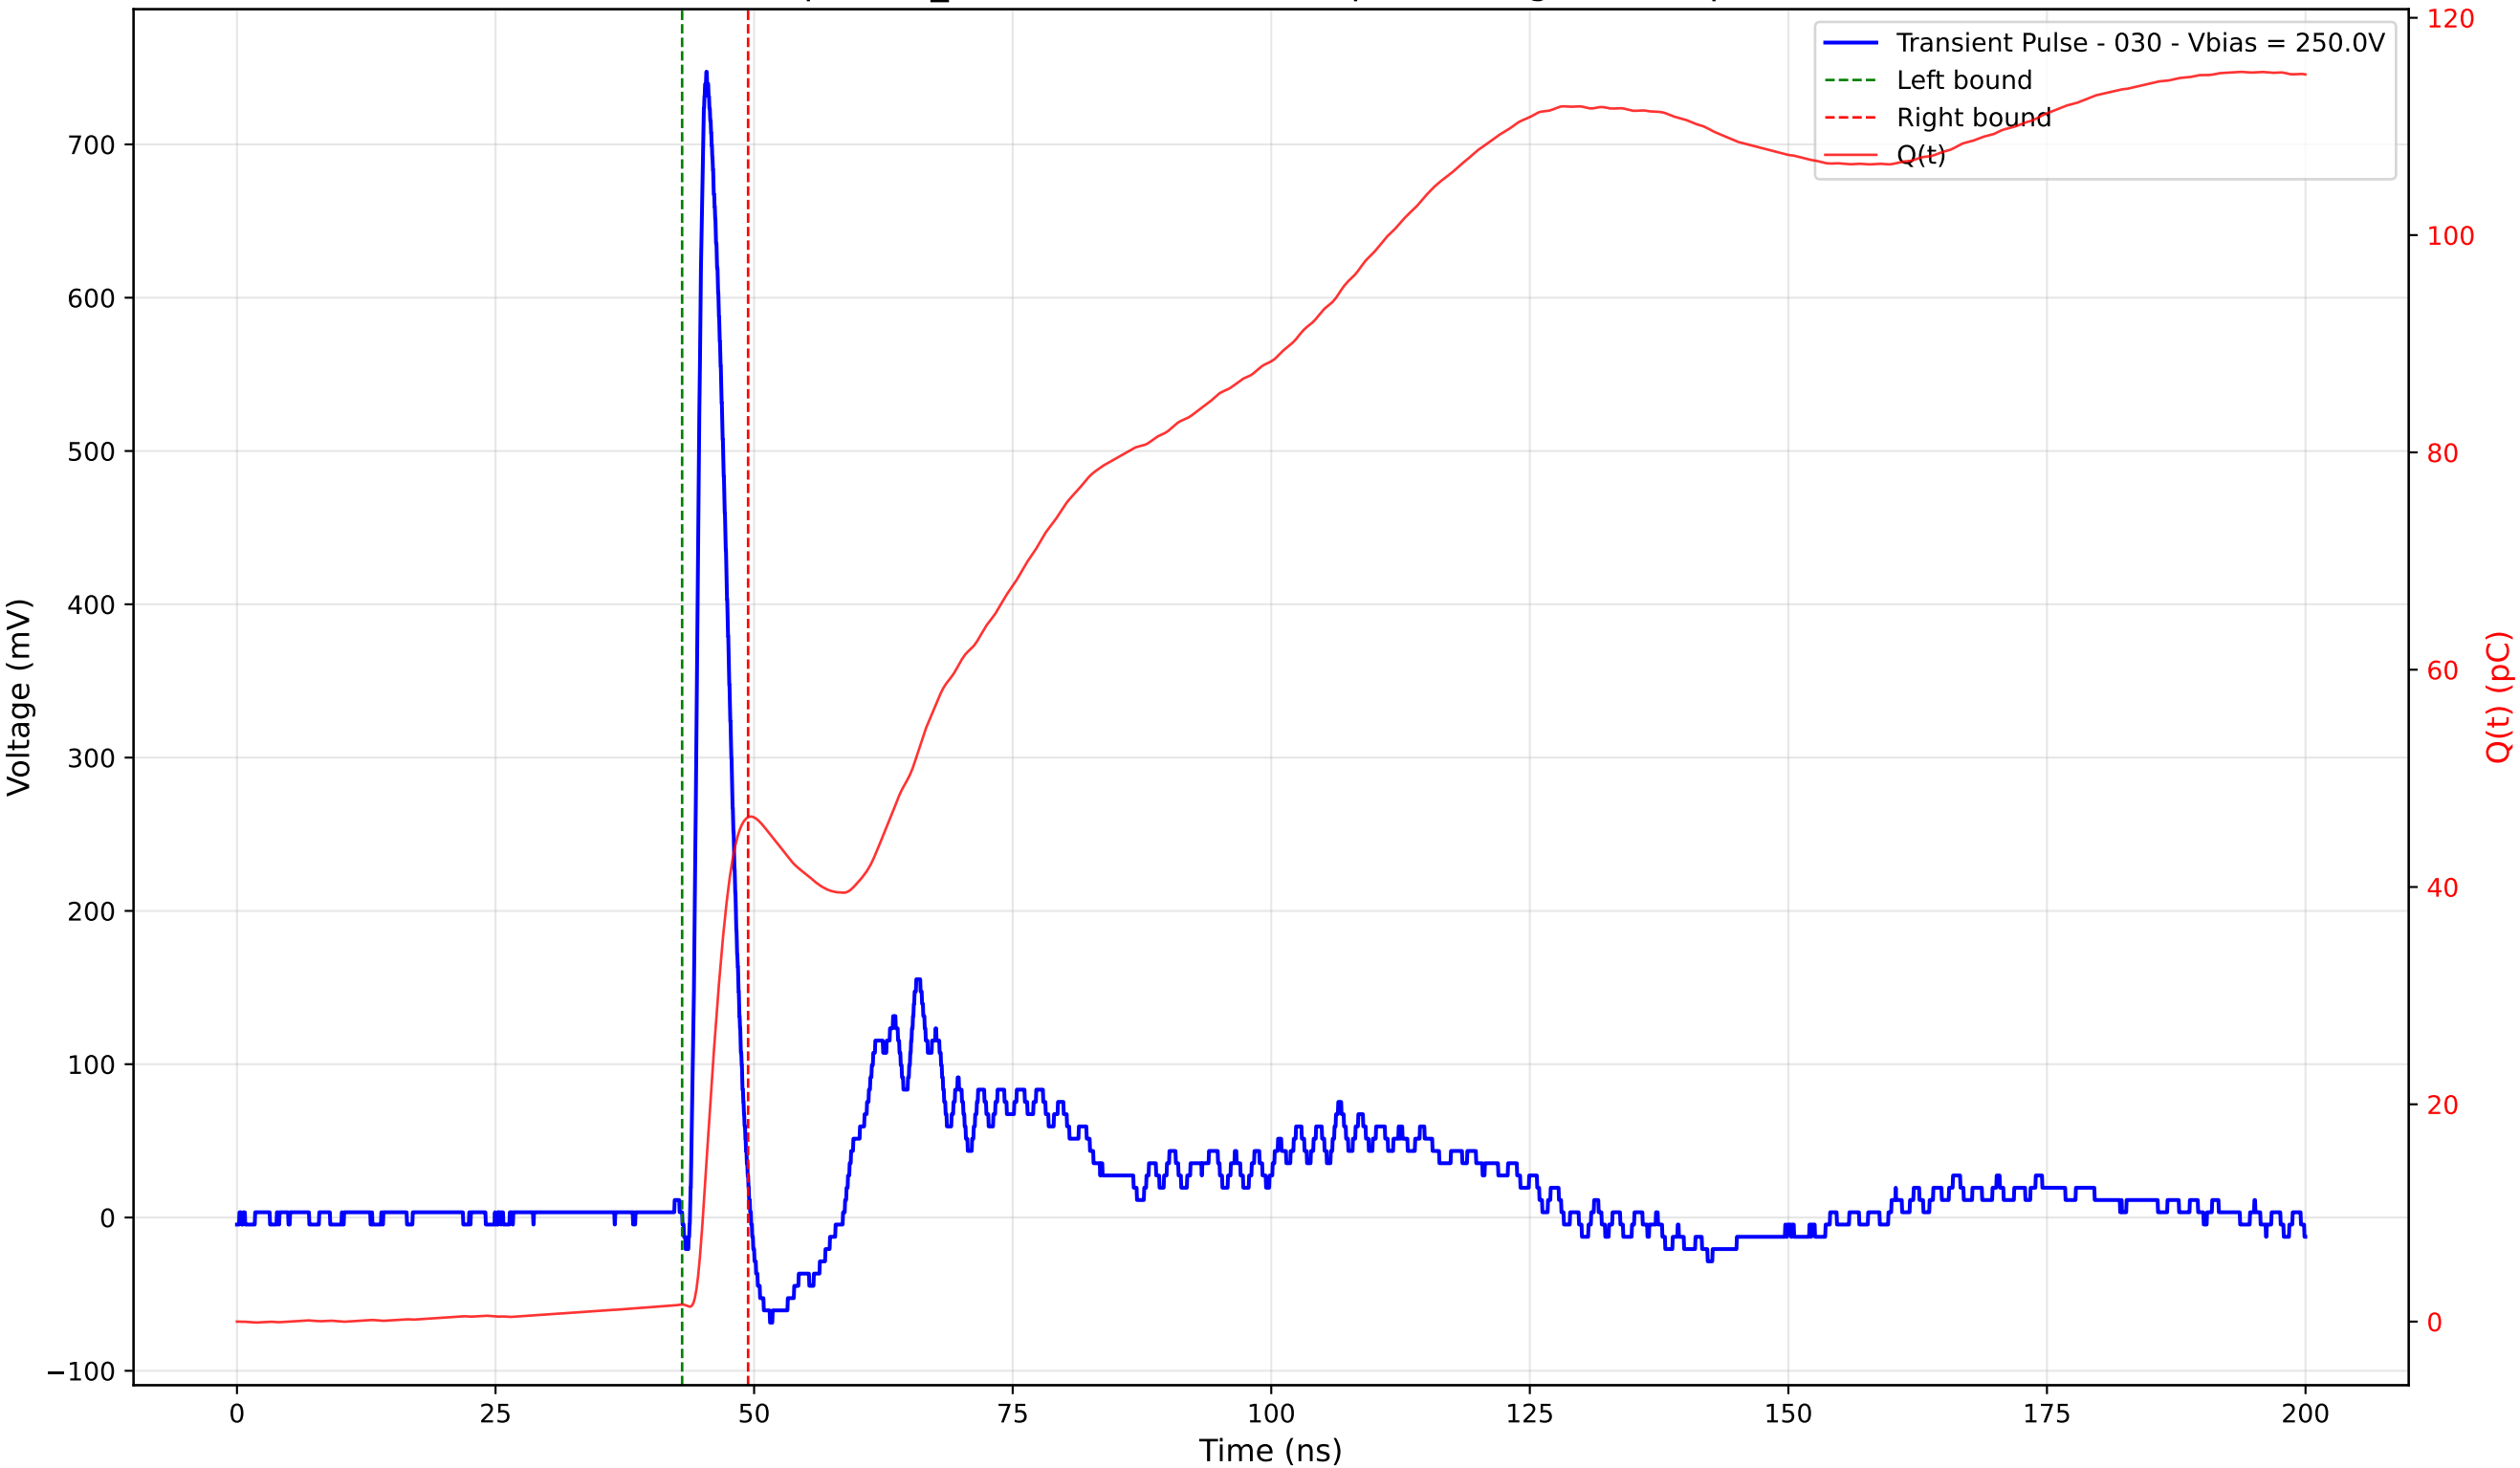


Transient Pulse - Sample: TD_4004 - Position: 250.0 μm - Charge: 44.86 pC - Rise Time: 0.93 ns

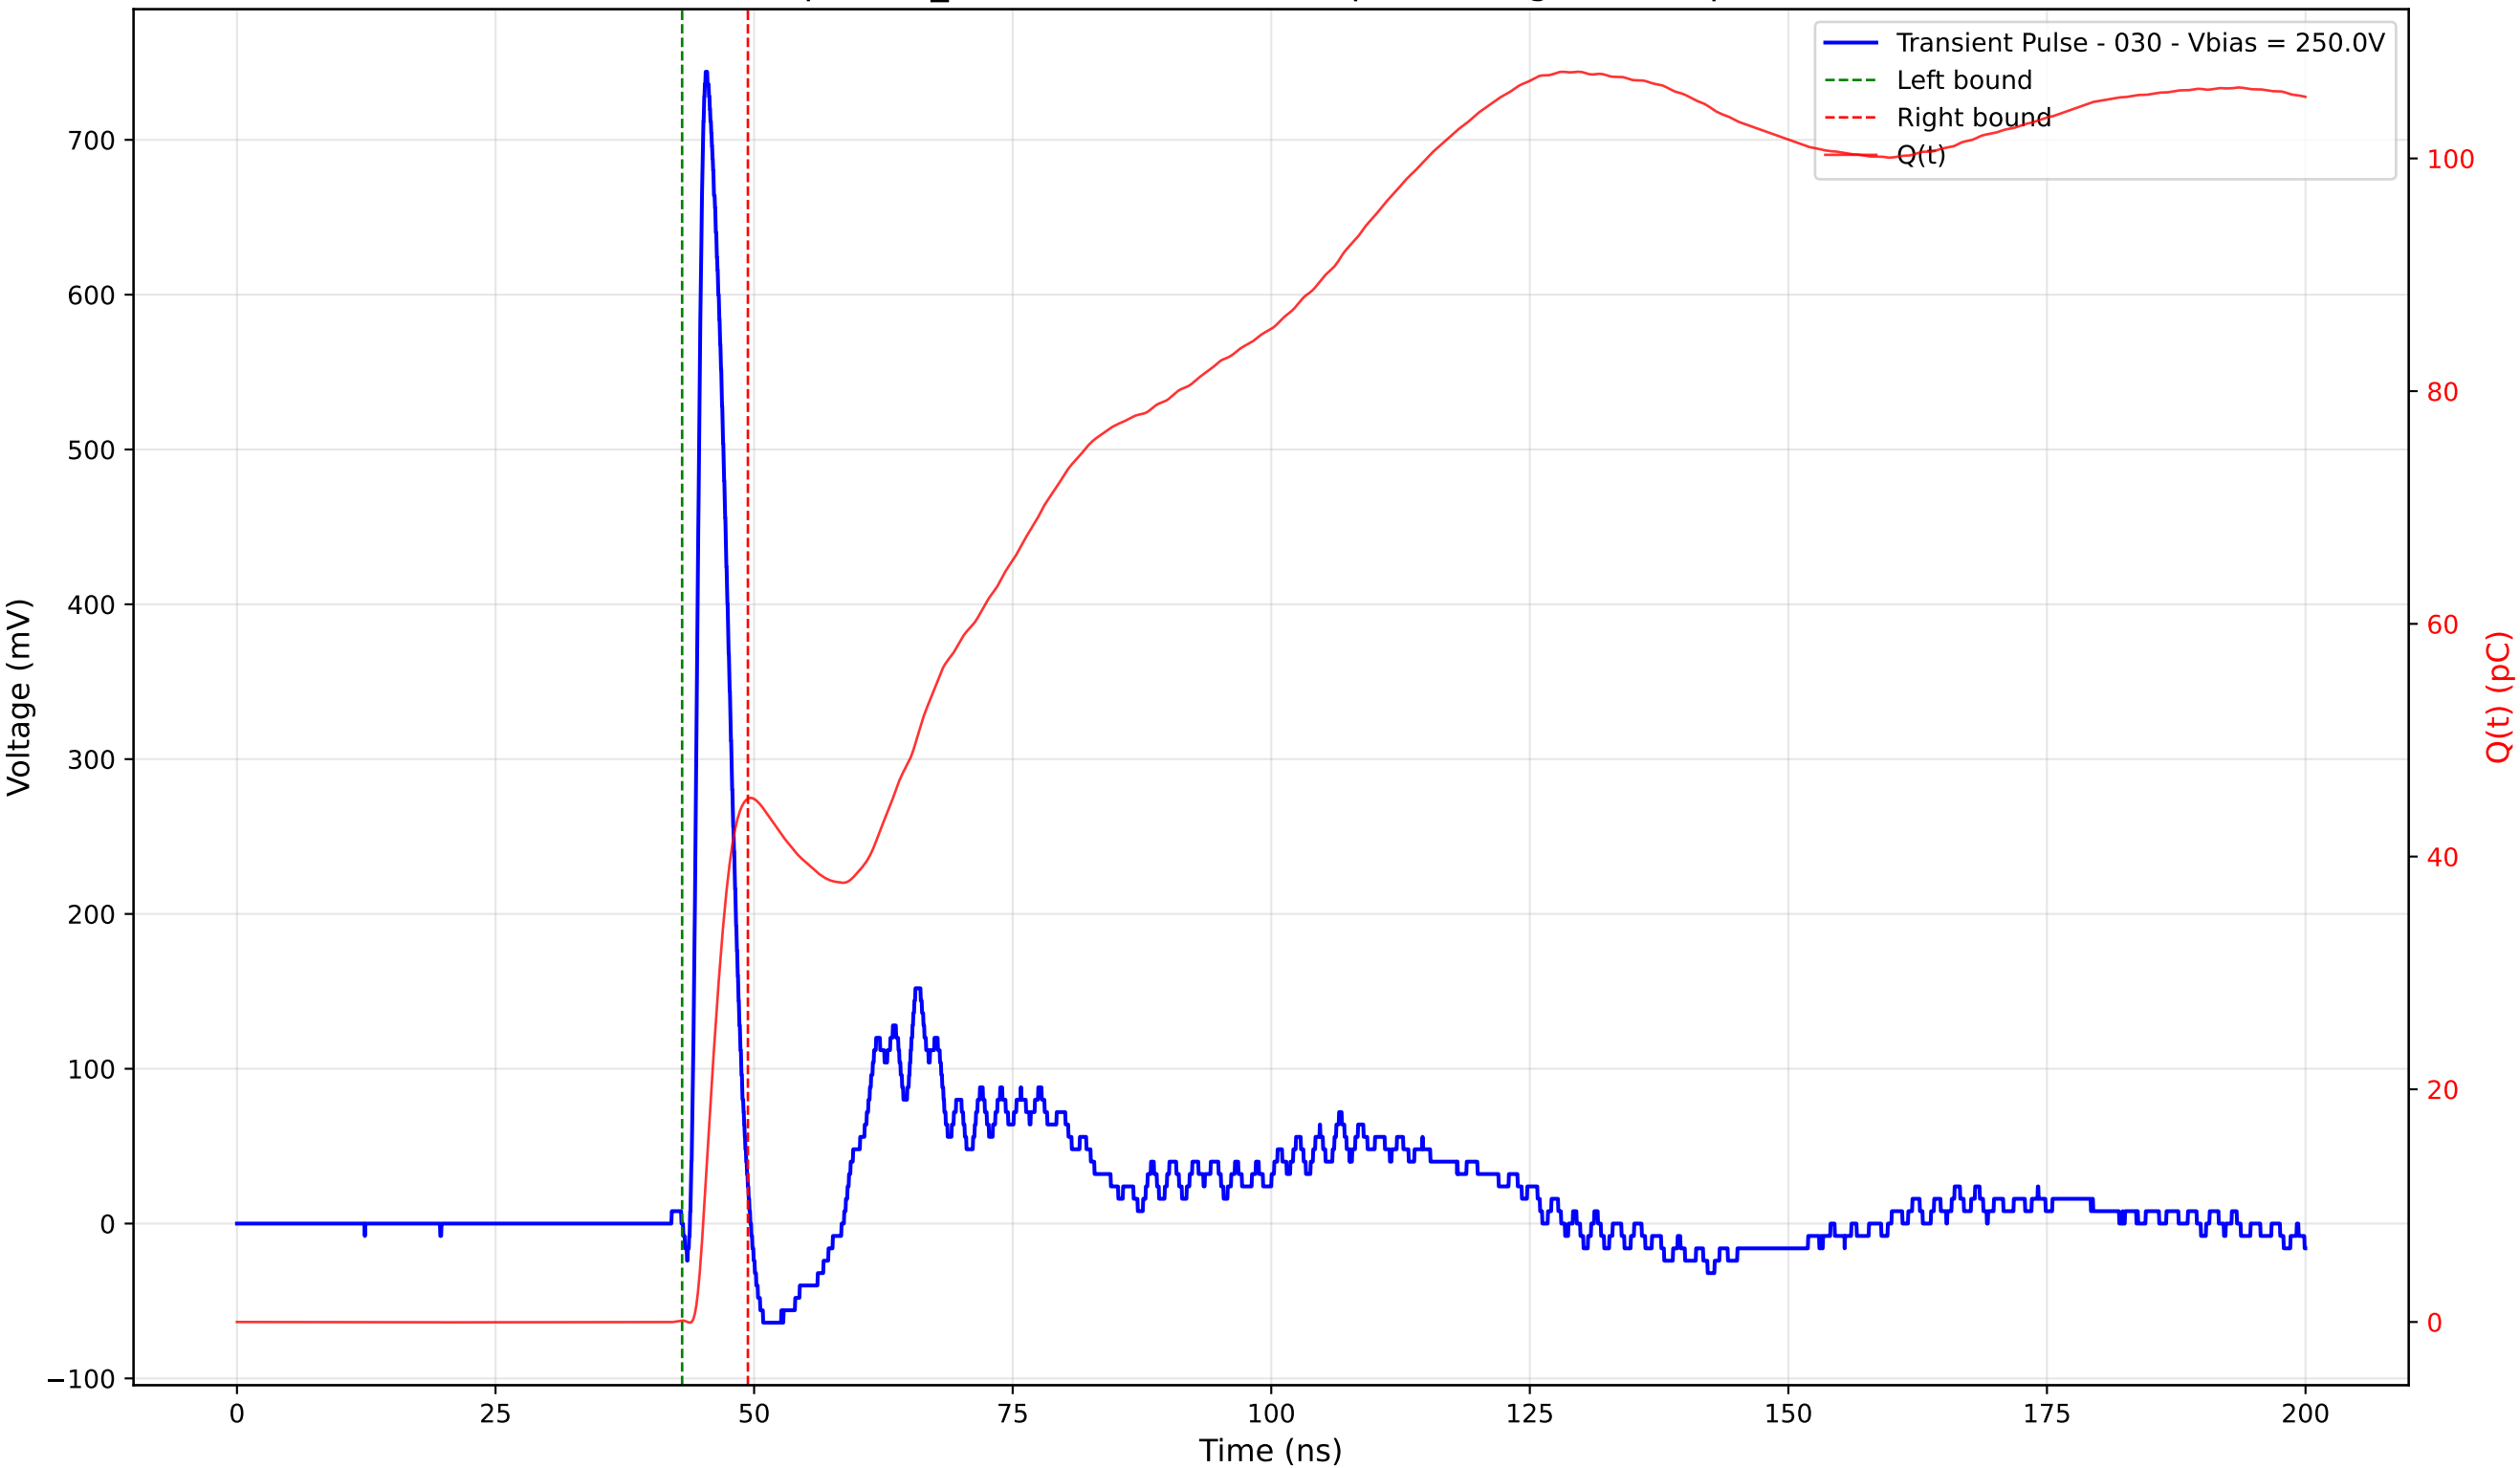


Transient Pulse - Sample: TD_4004 - Position: 255.0 μm - Charge: 44.45 pC - Rise Time: 0.93 ns

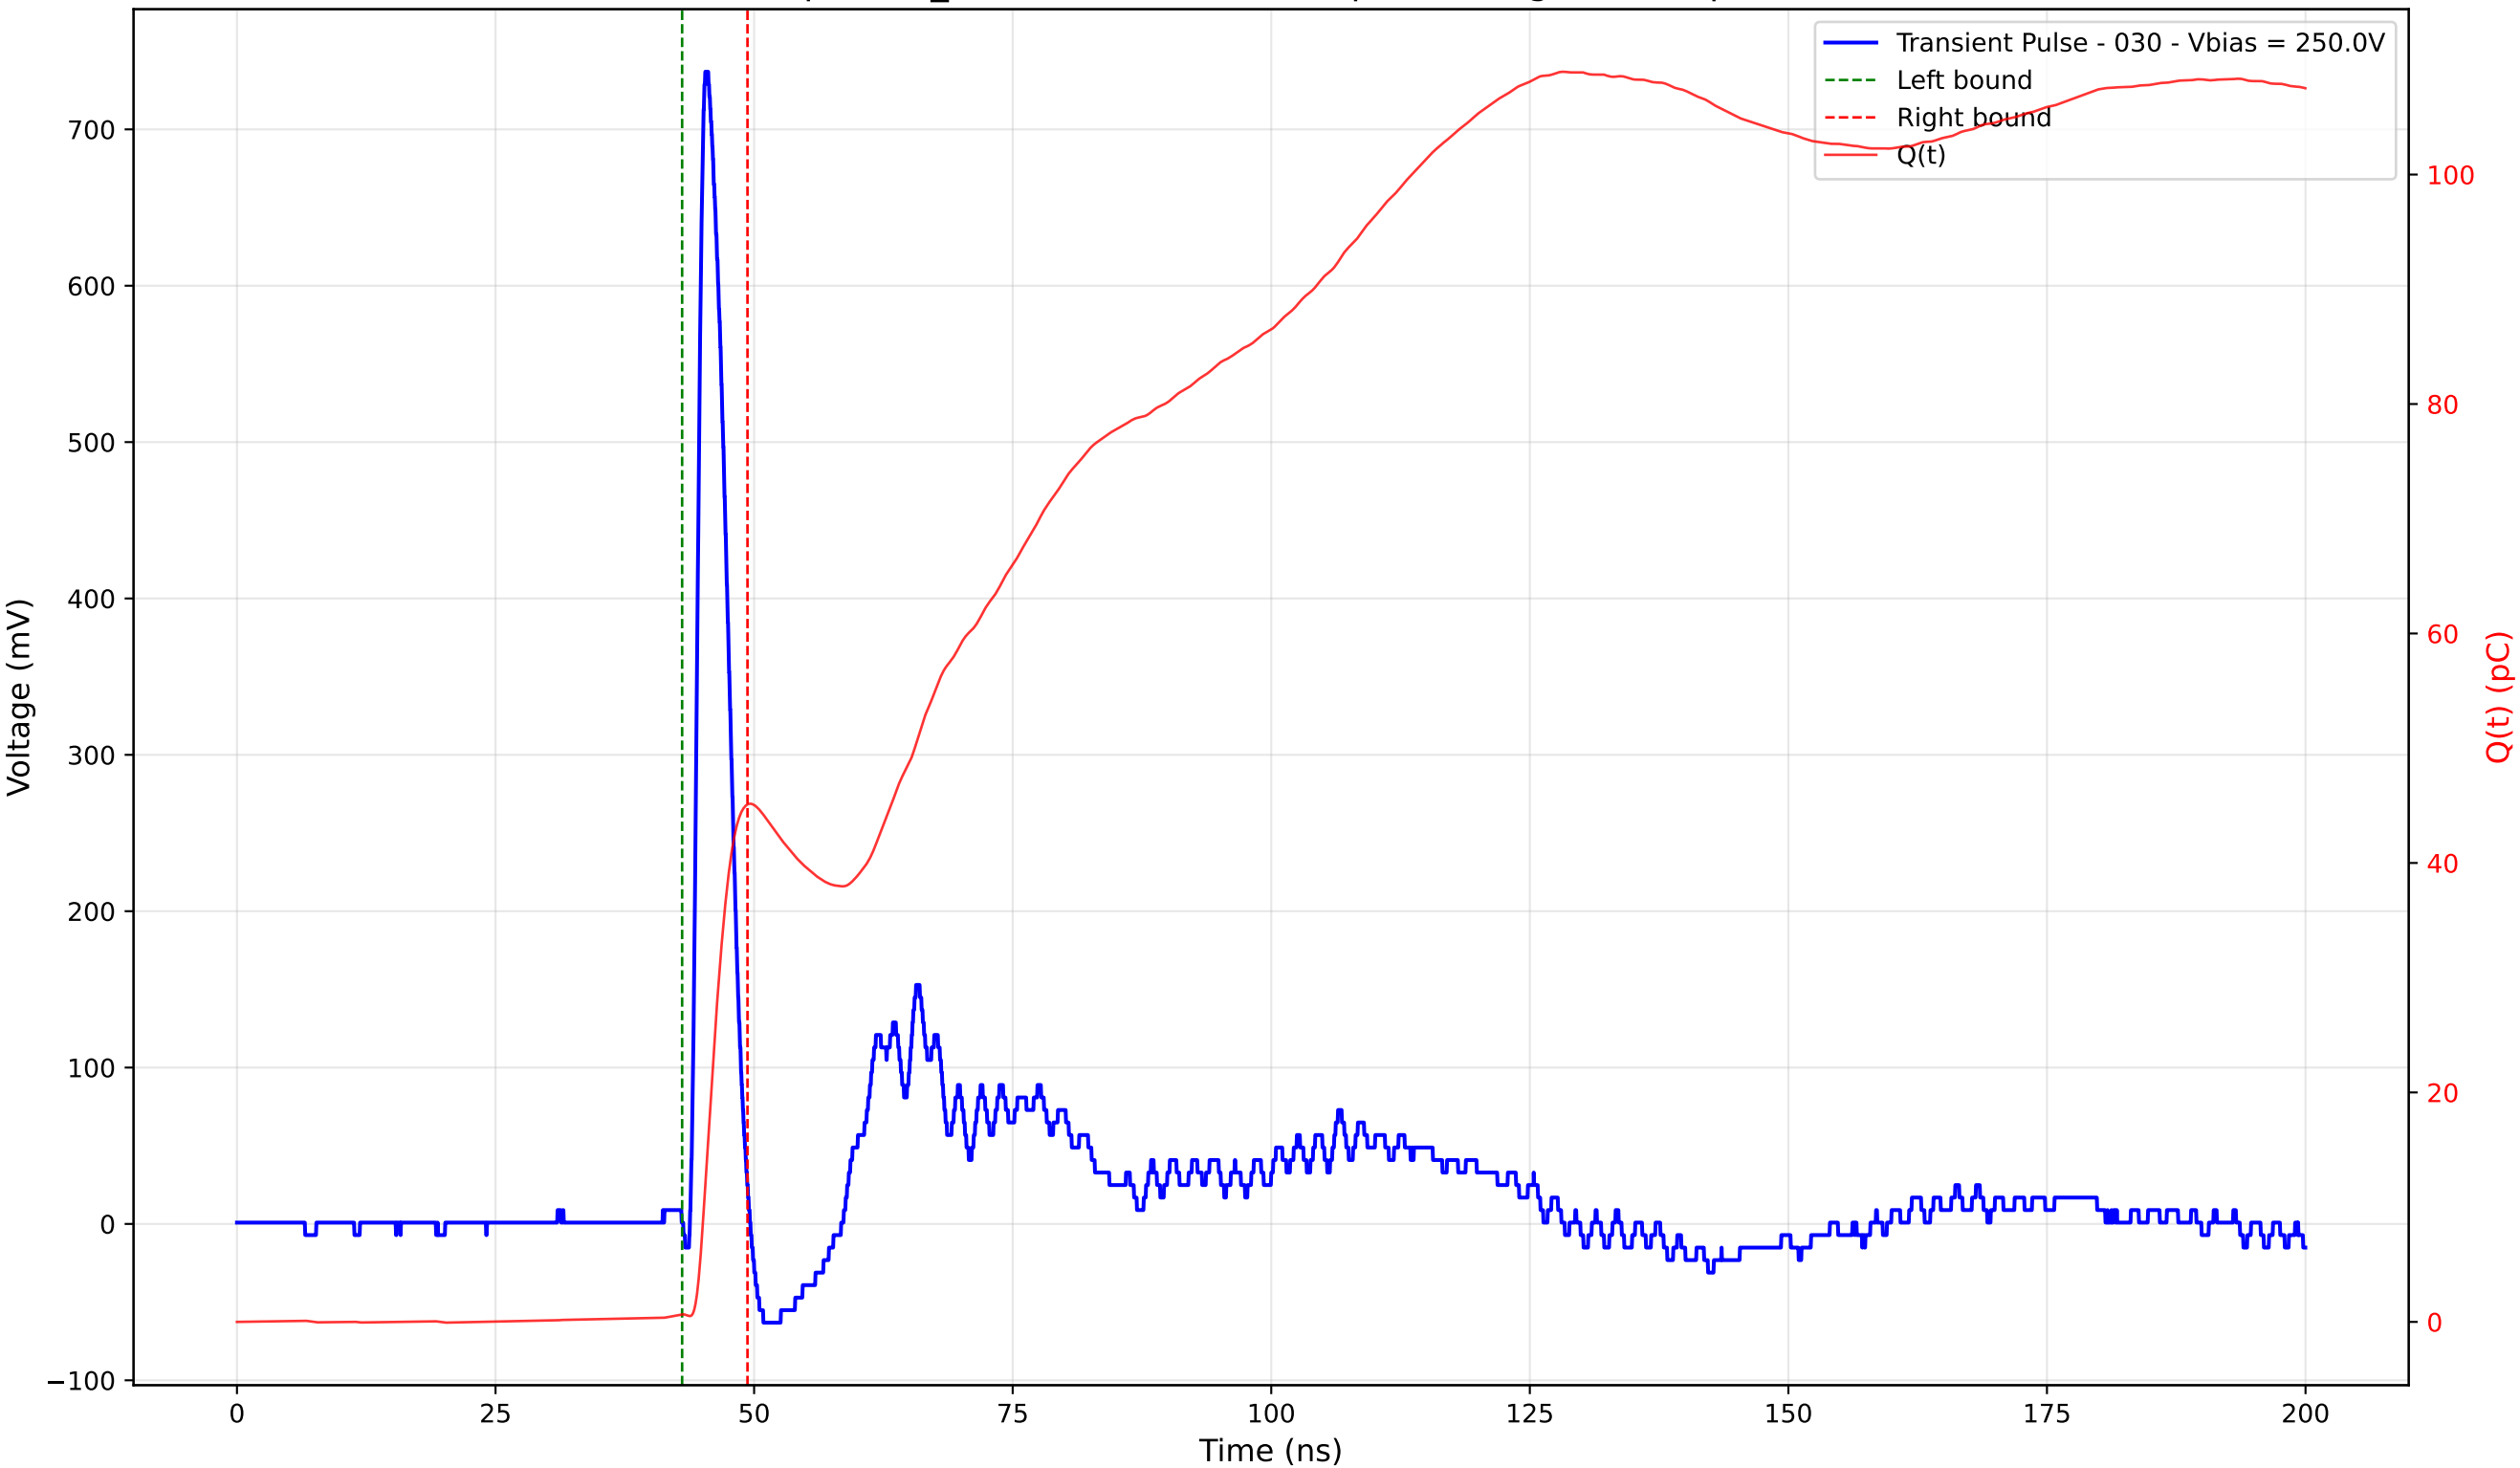


Transient Pulse - Sample: TD_4004 - Position: 260.0 μm - Charge: 43.89 pC - Rise Time: 0.95 ns

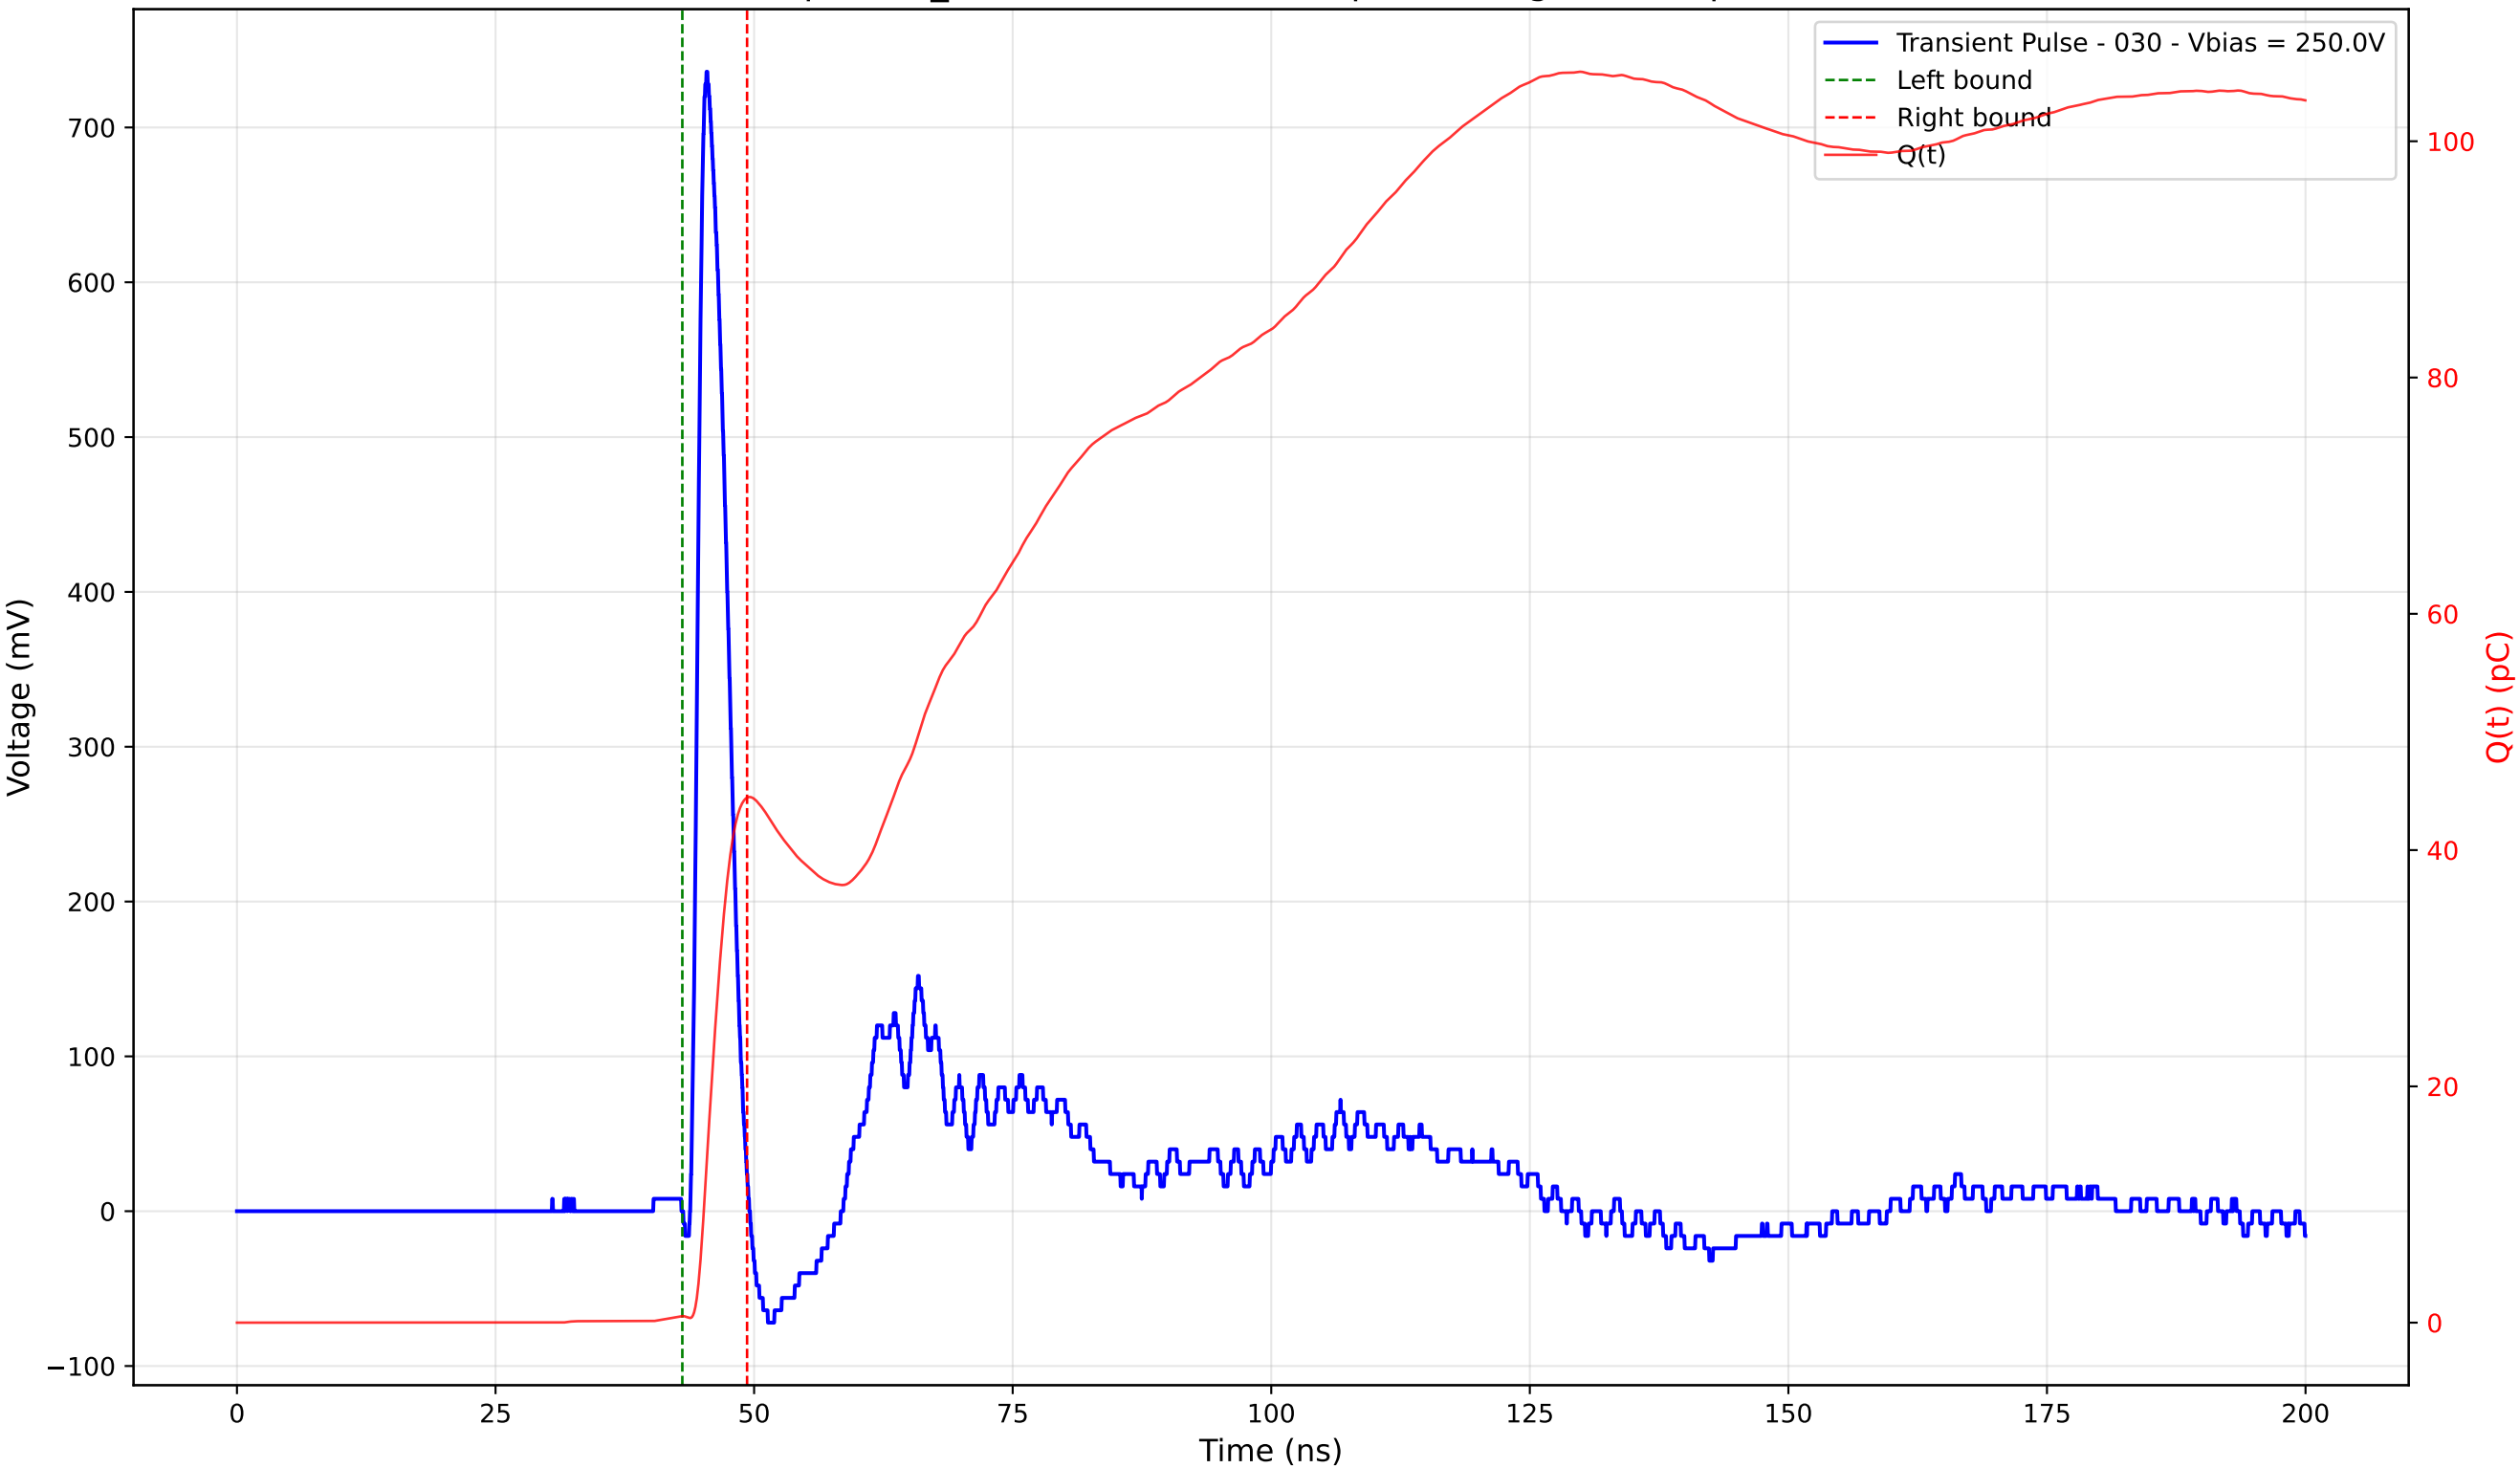


Transient Pulse - Sample: TD_4004 - Position: 265.0 μm - Charge: 43.93 pC - Rise Time: 0.96 ns

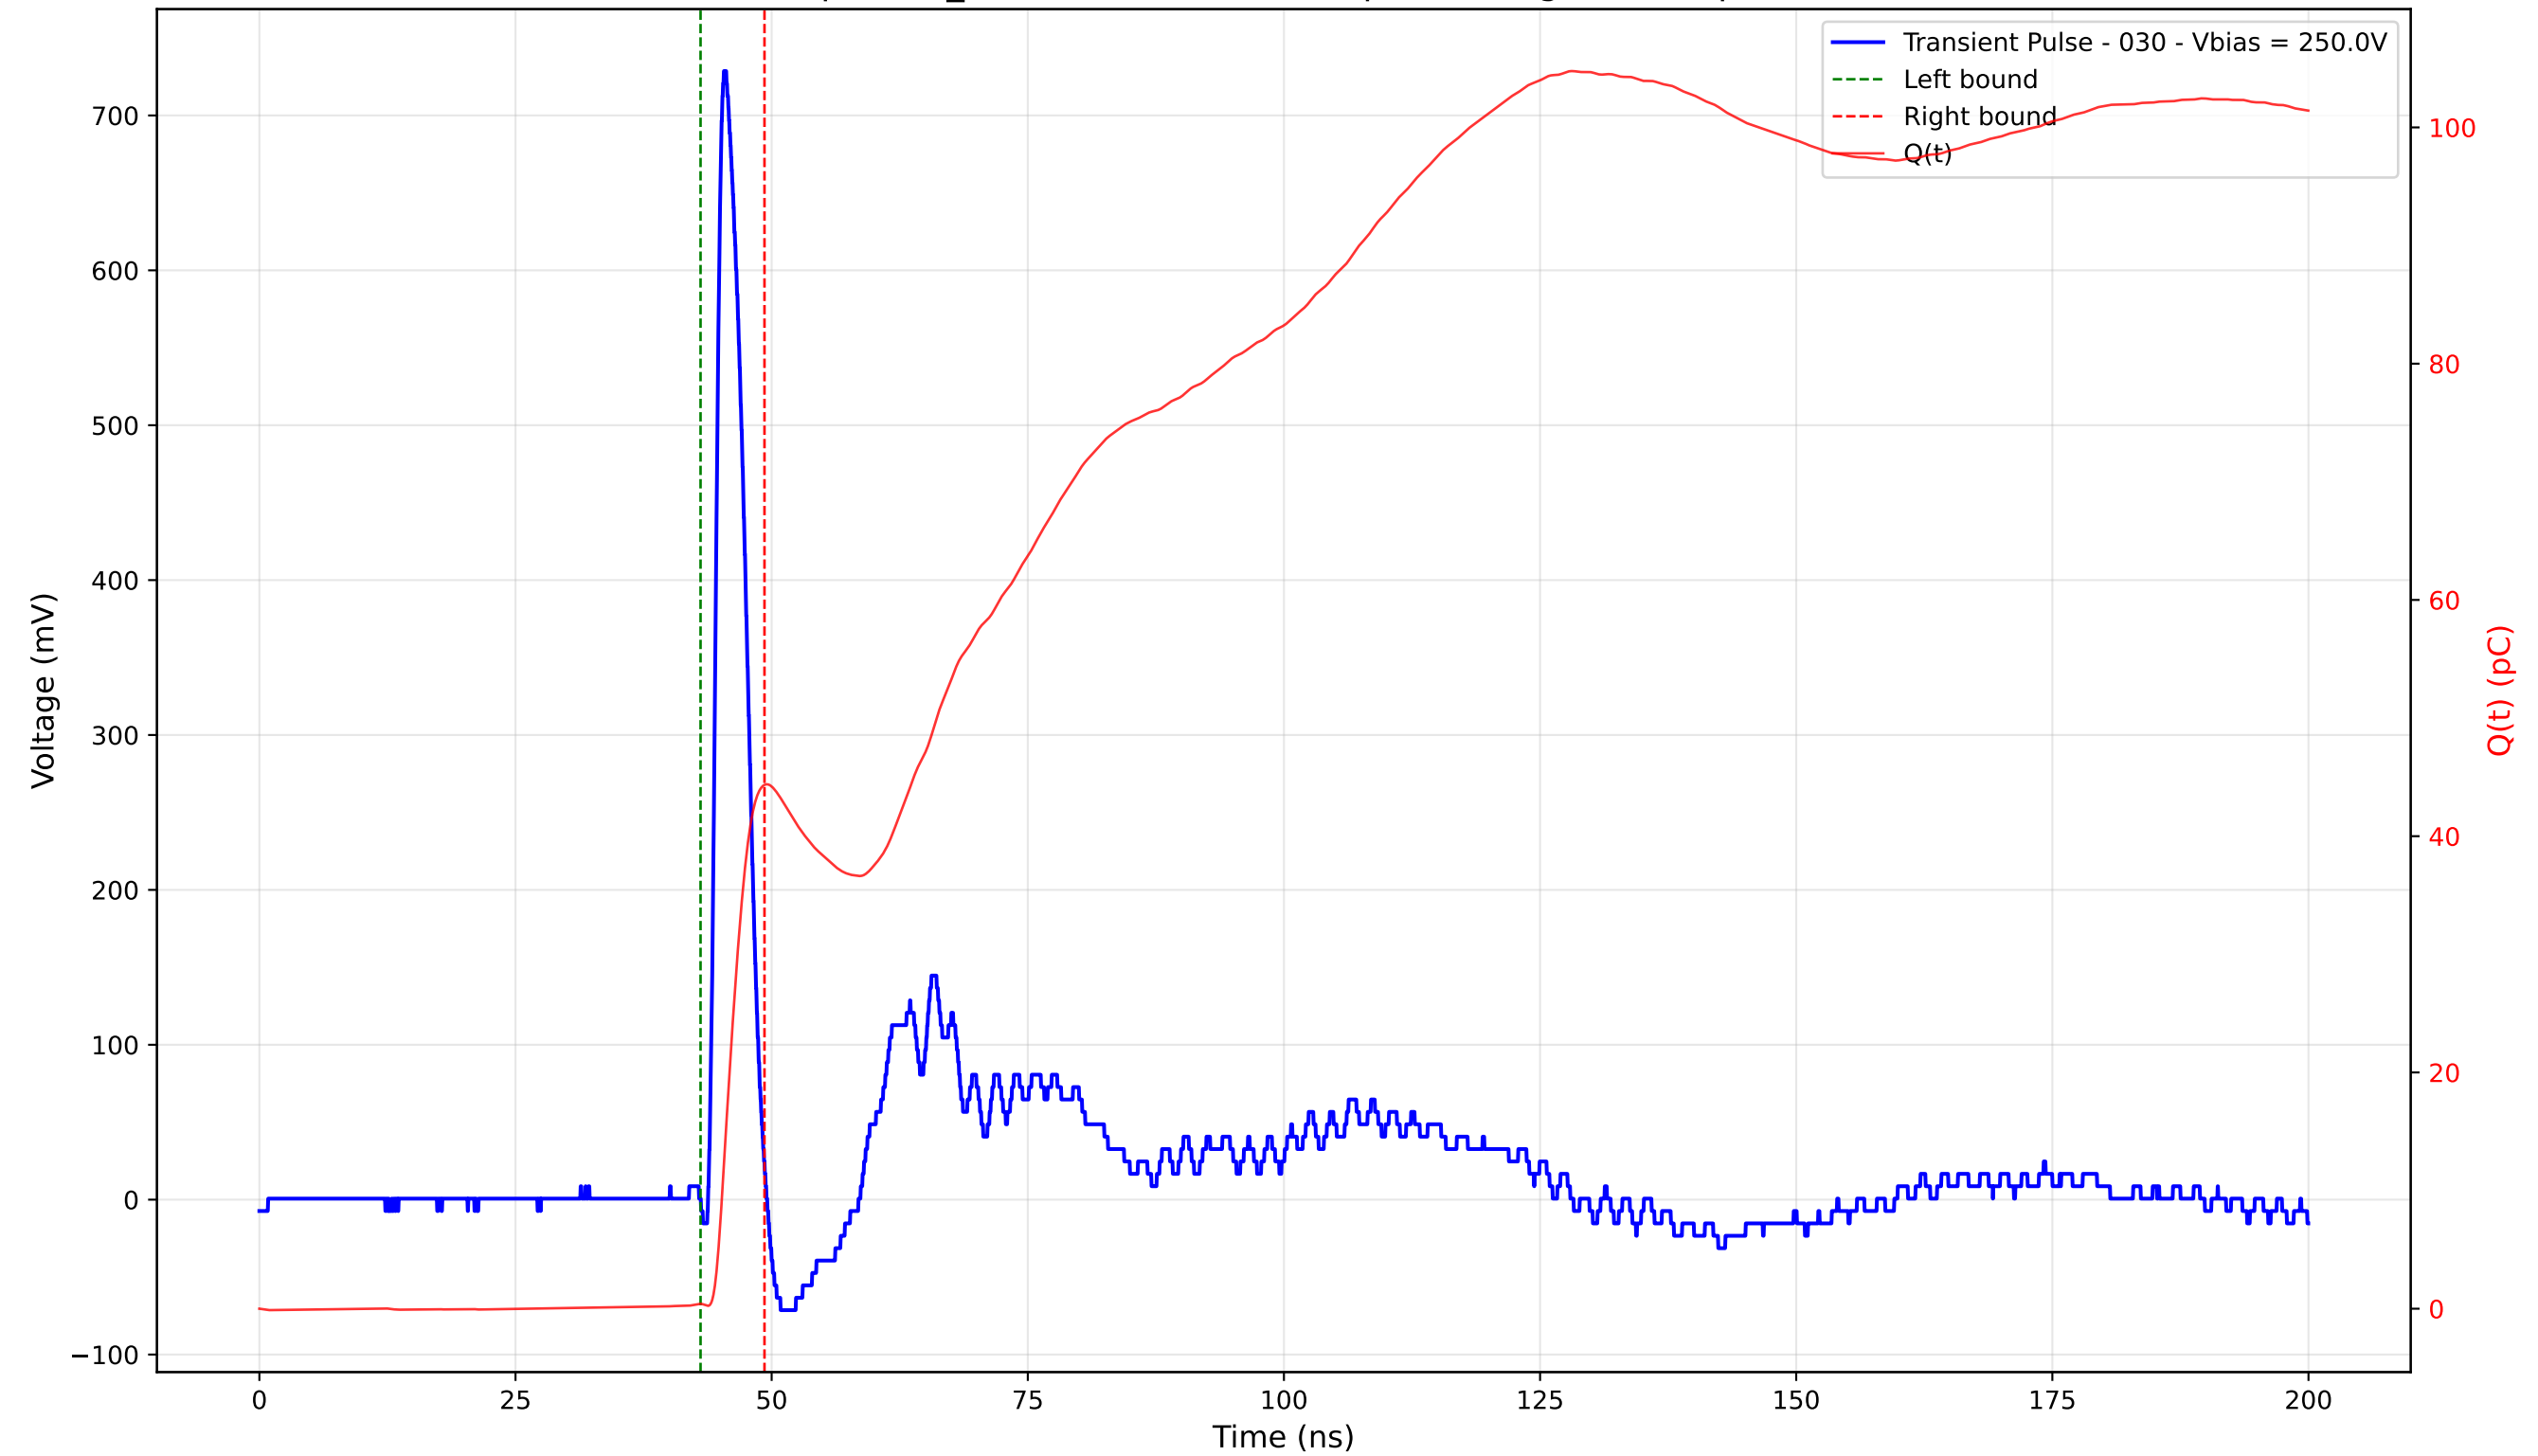


Transient Pulse - Sample: TD_4004 - Position: 270.0 μm - Charge: 44.72 pC - Rise Time: 0.93 ns

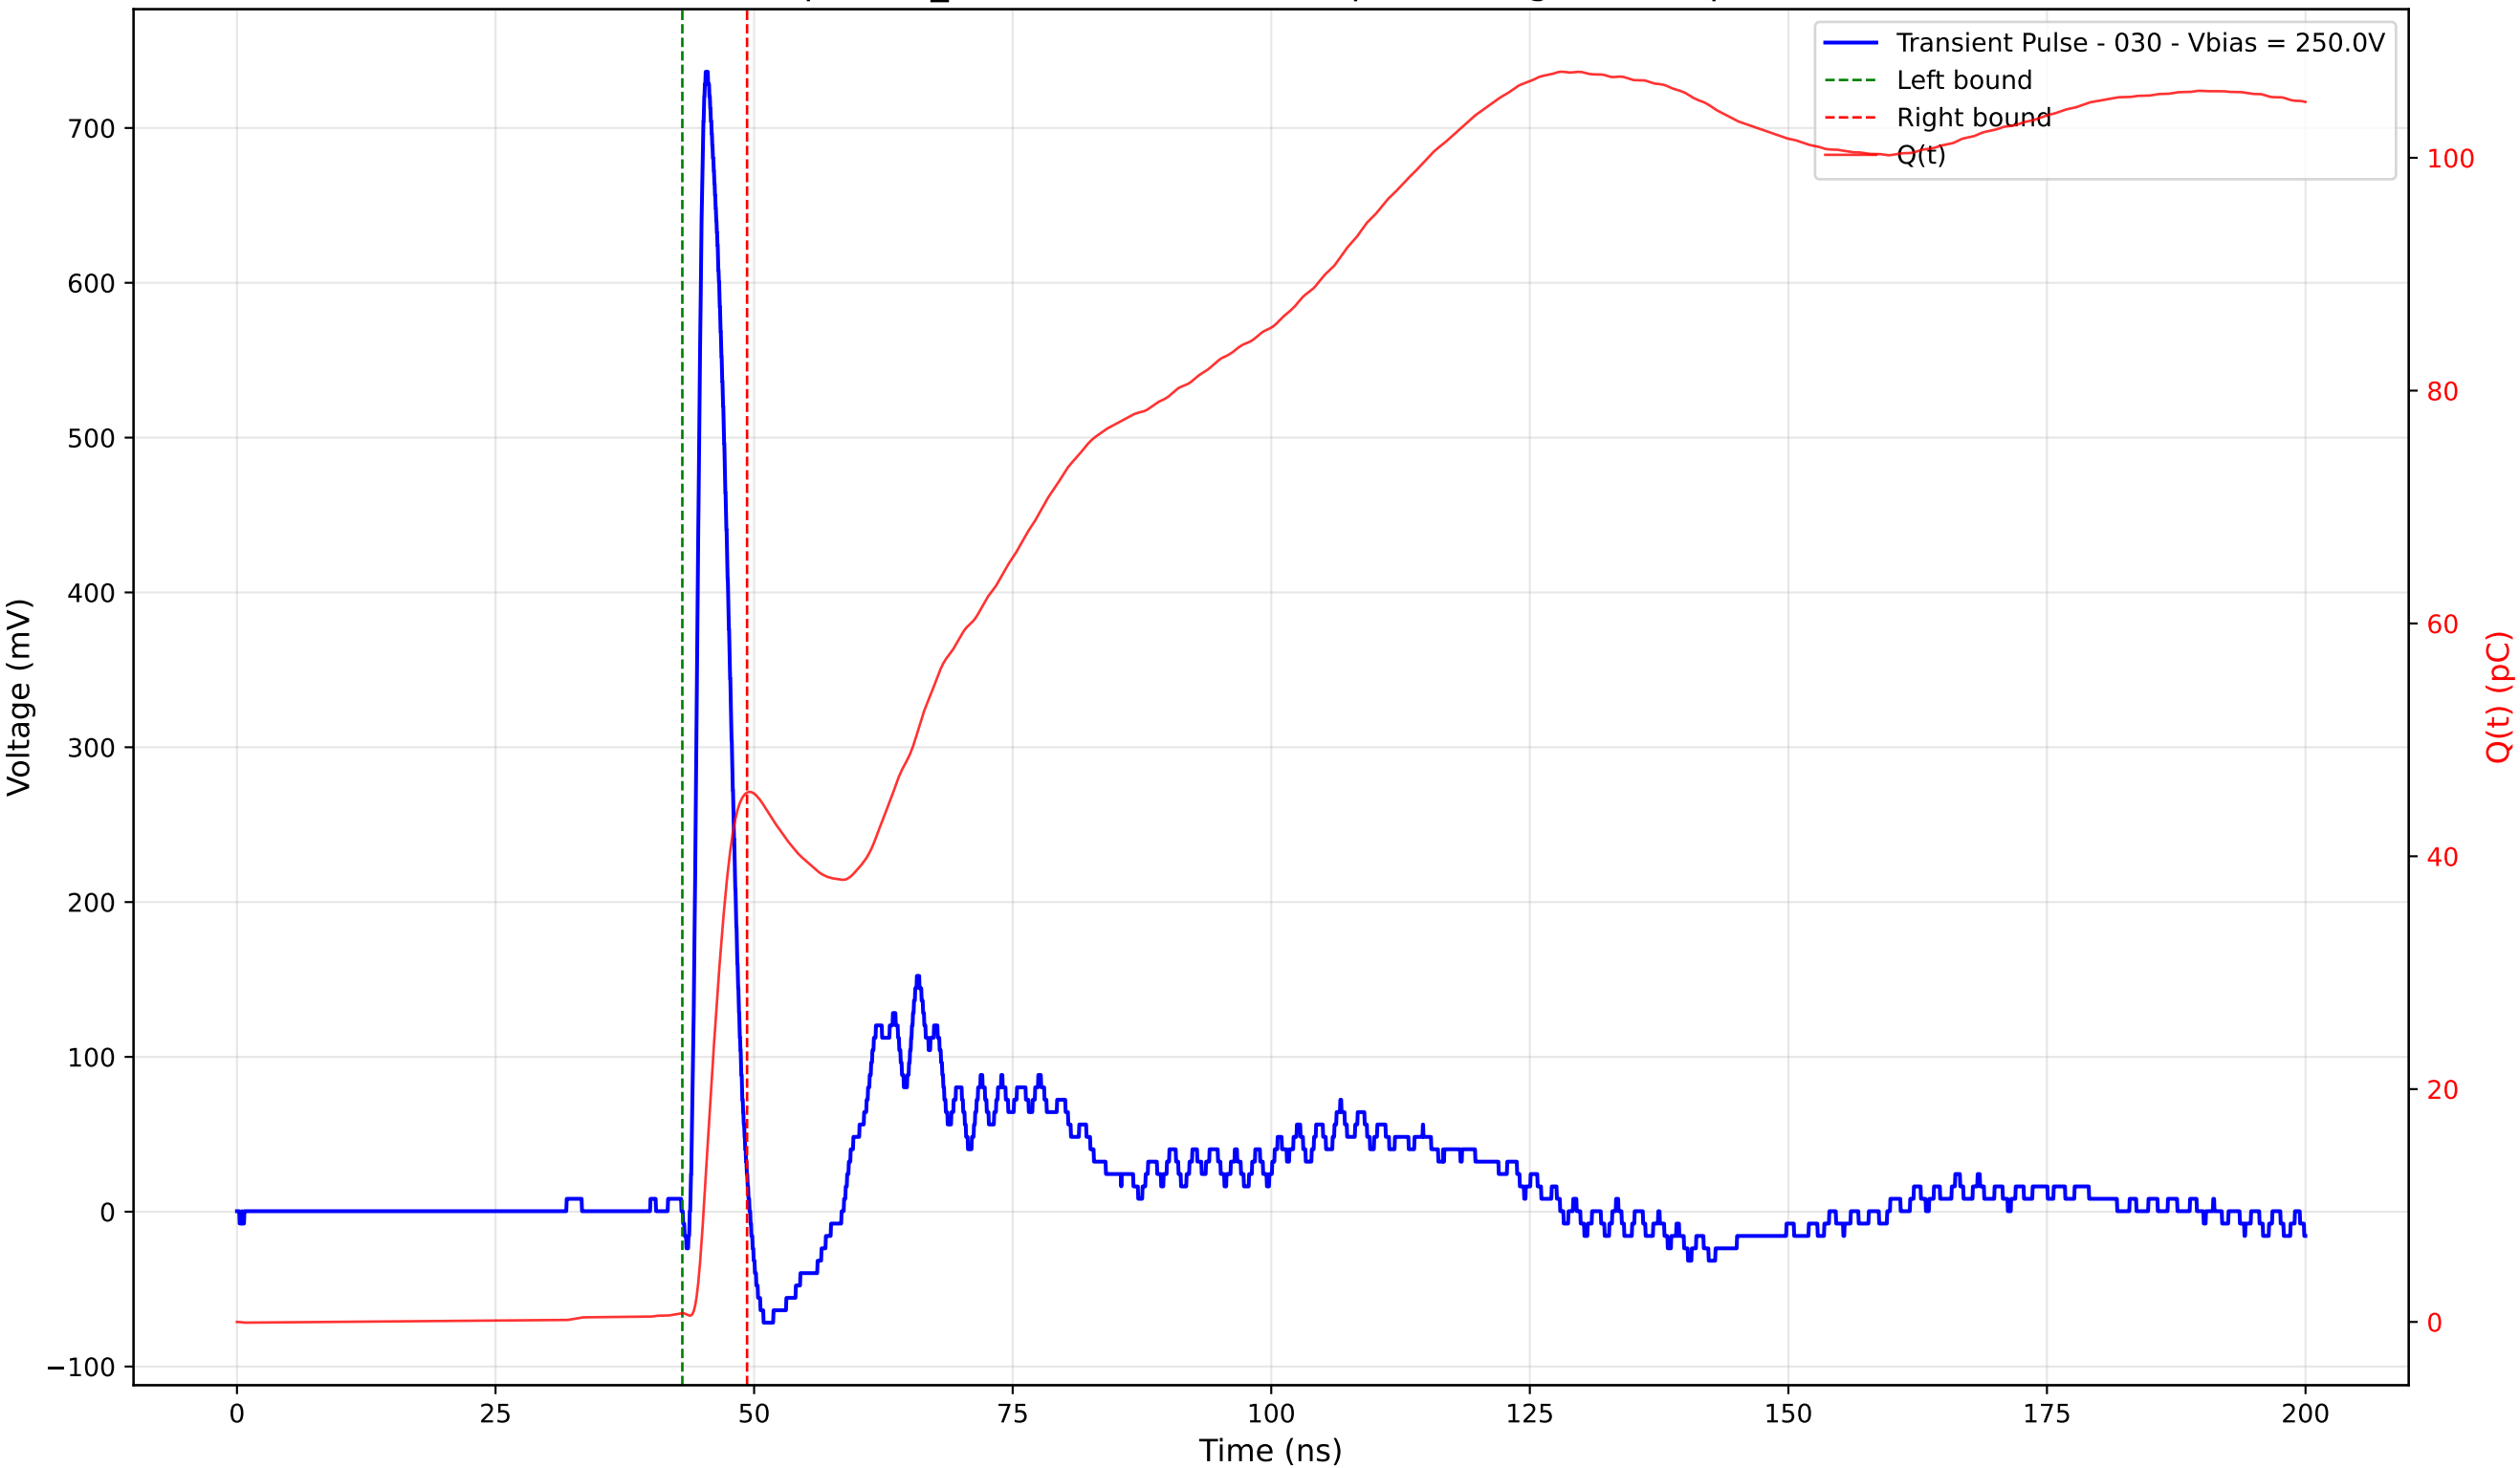


Transient Pulse - Sample: TD_4004 - Position: 275.0 μm - Charge: 45.62 pC - Rise Time: 0.94 ns

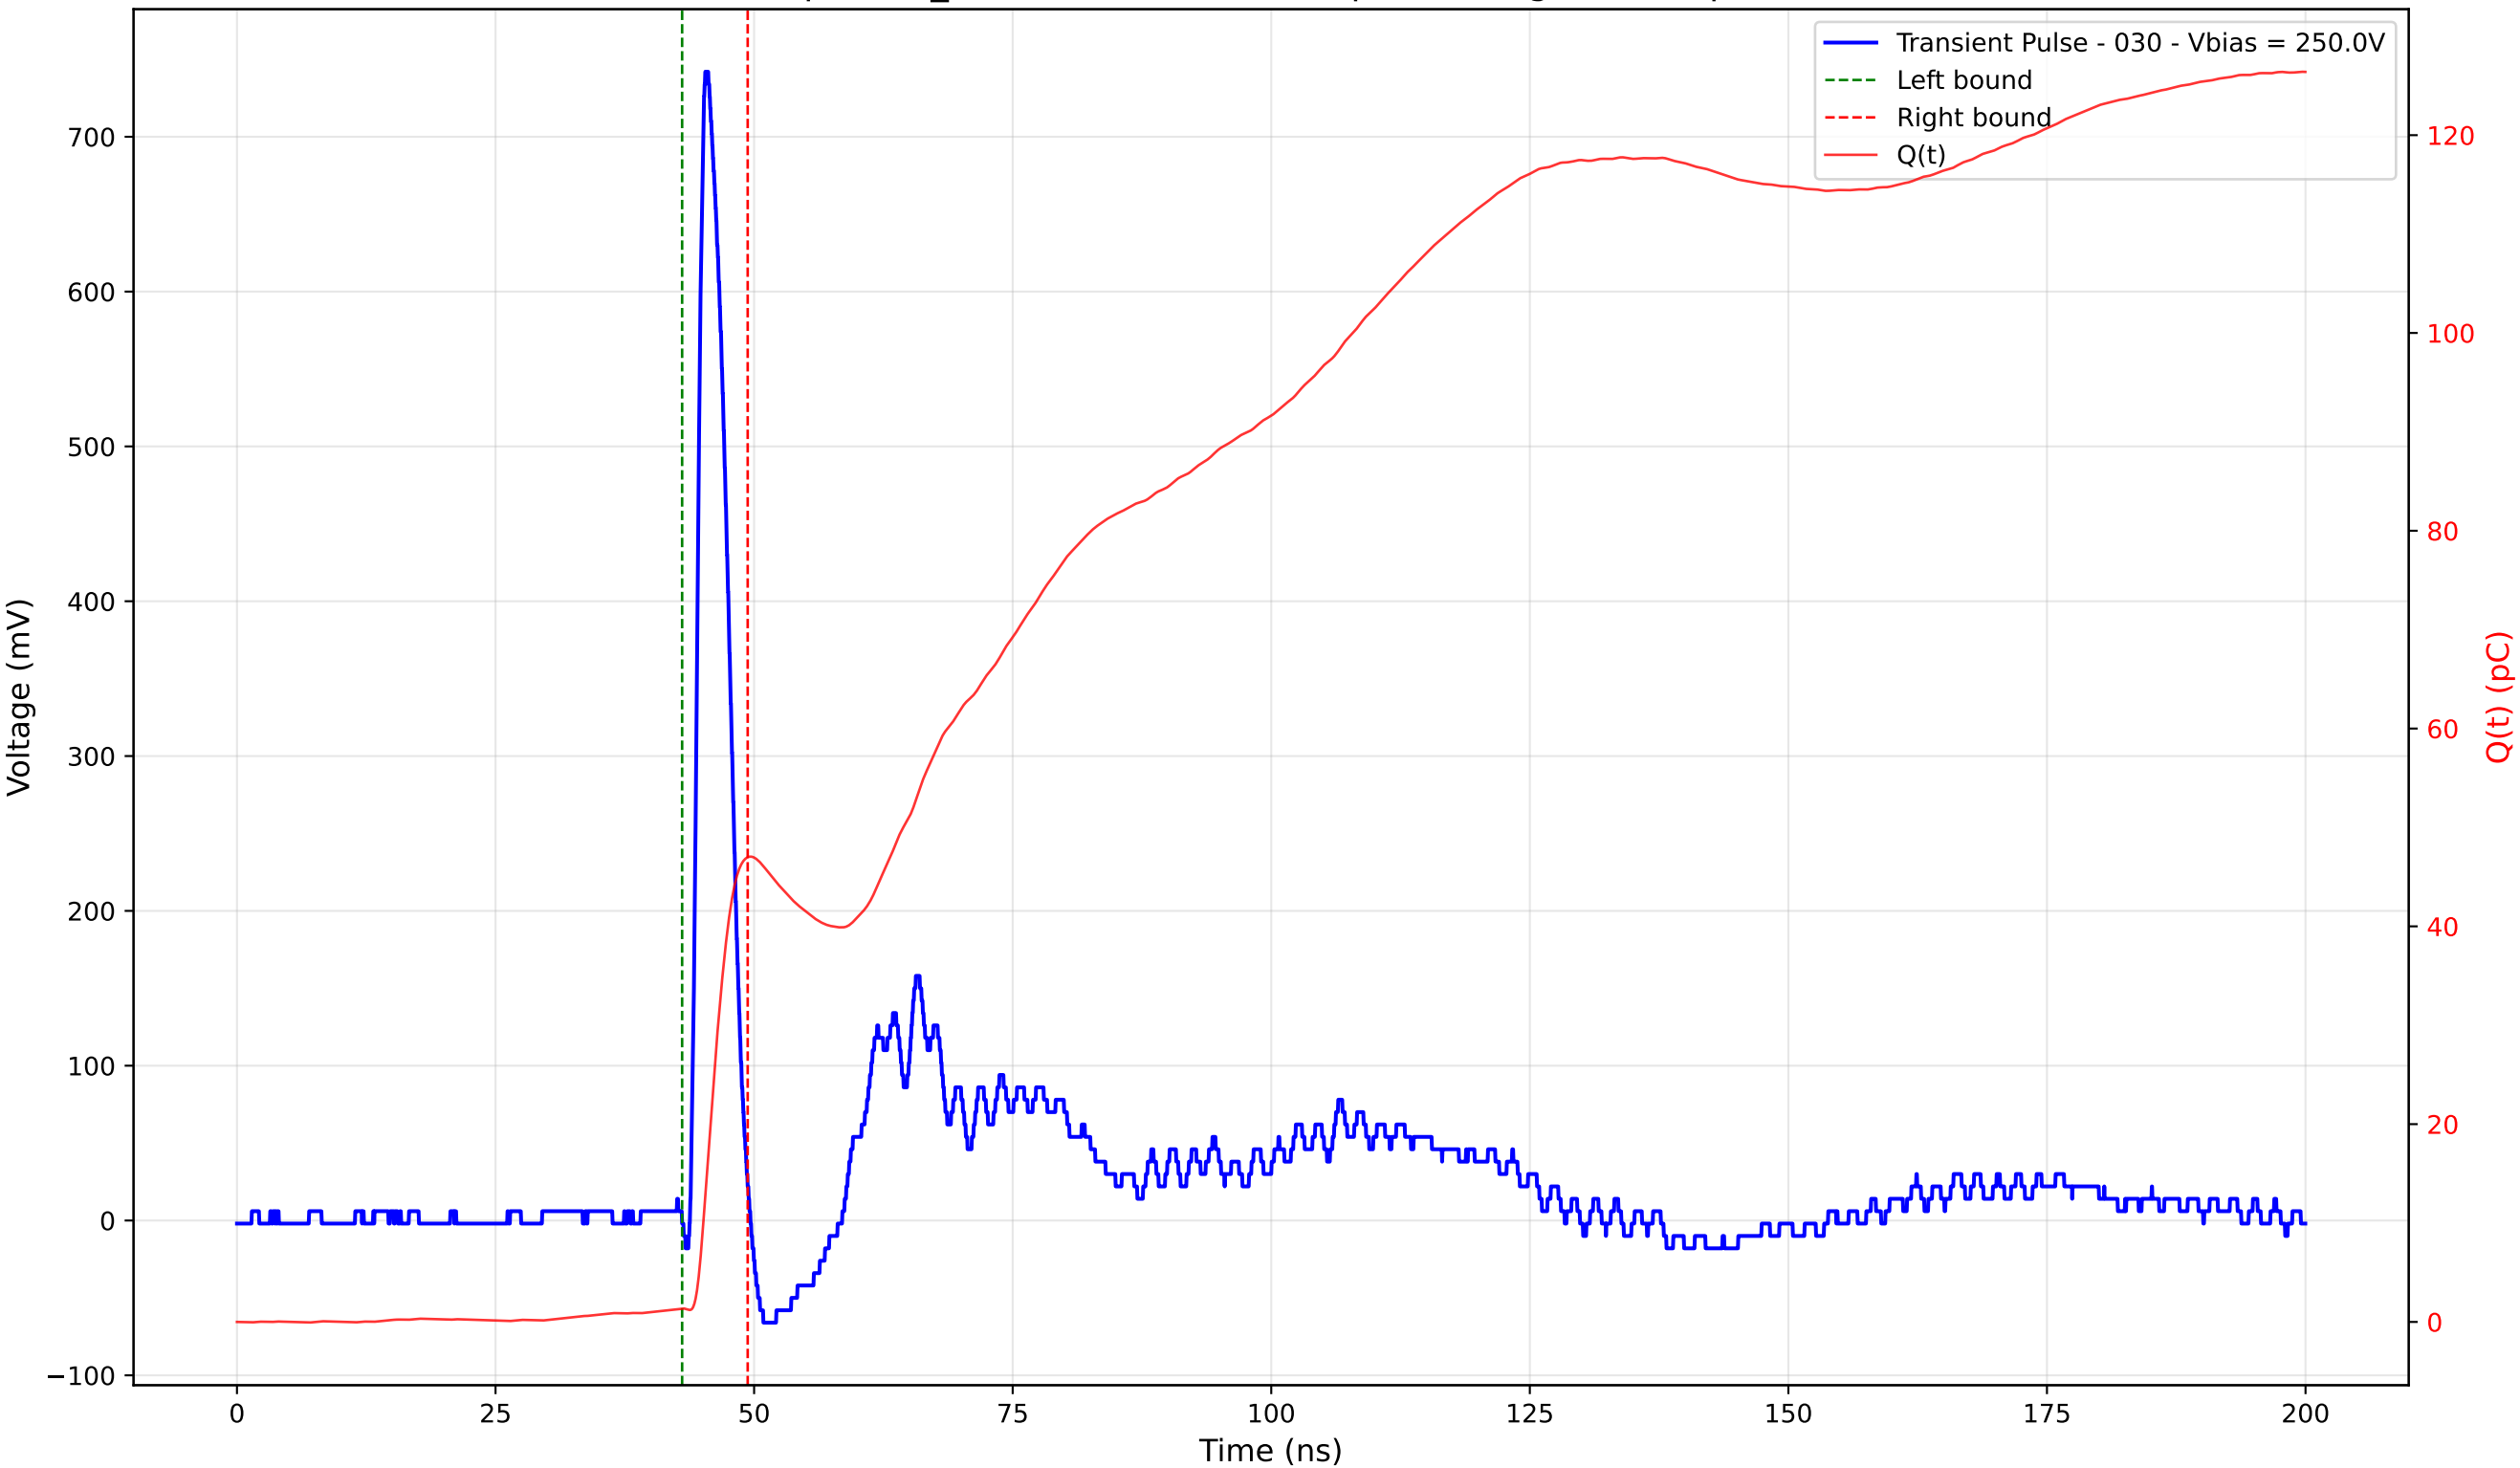


Transient Pulse - Sample: TD_4004 - Position: 280.0 μm - Charge: 45.68 pC - Rise Time: 0.93 ns

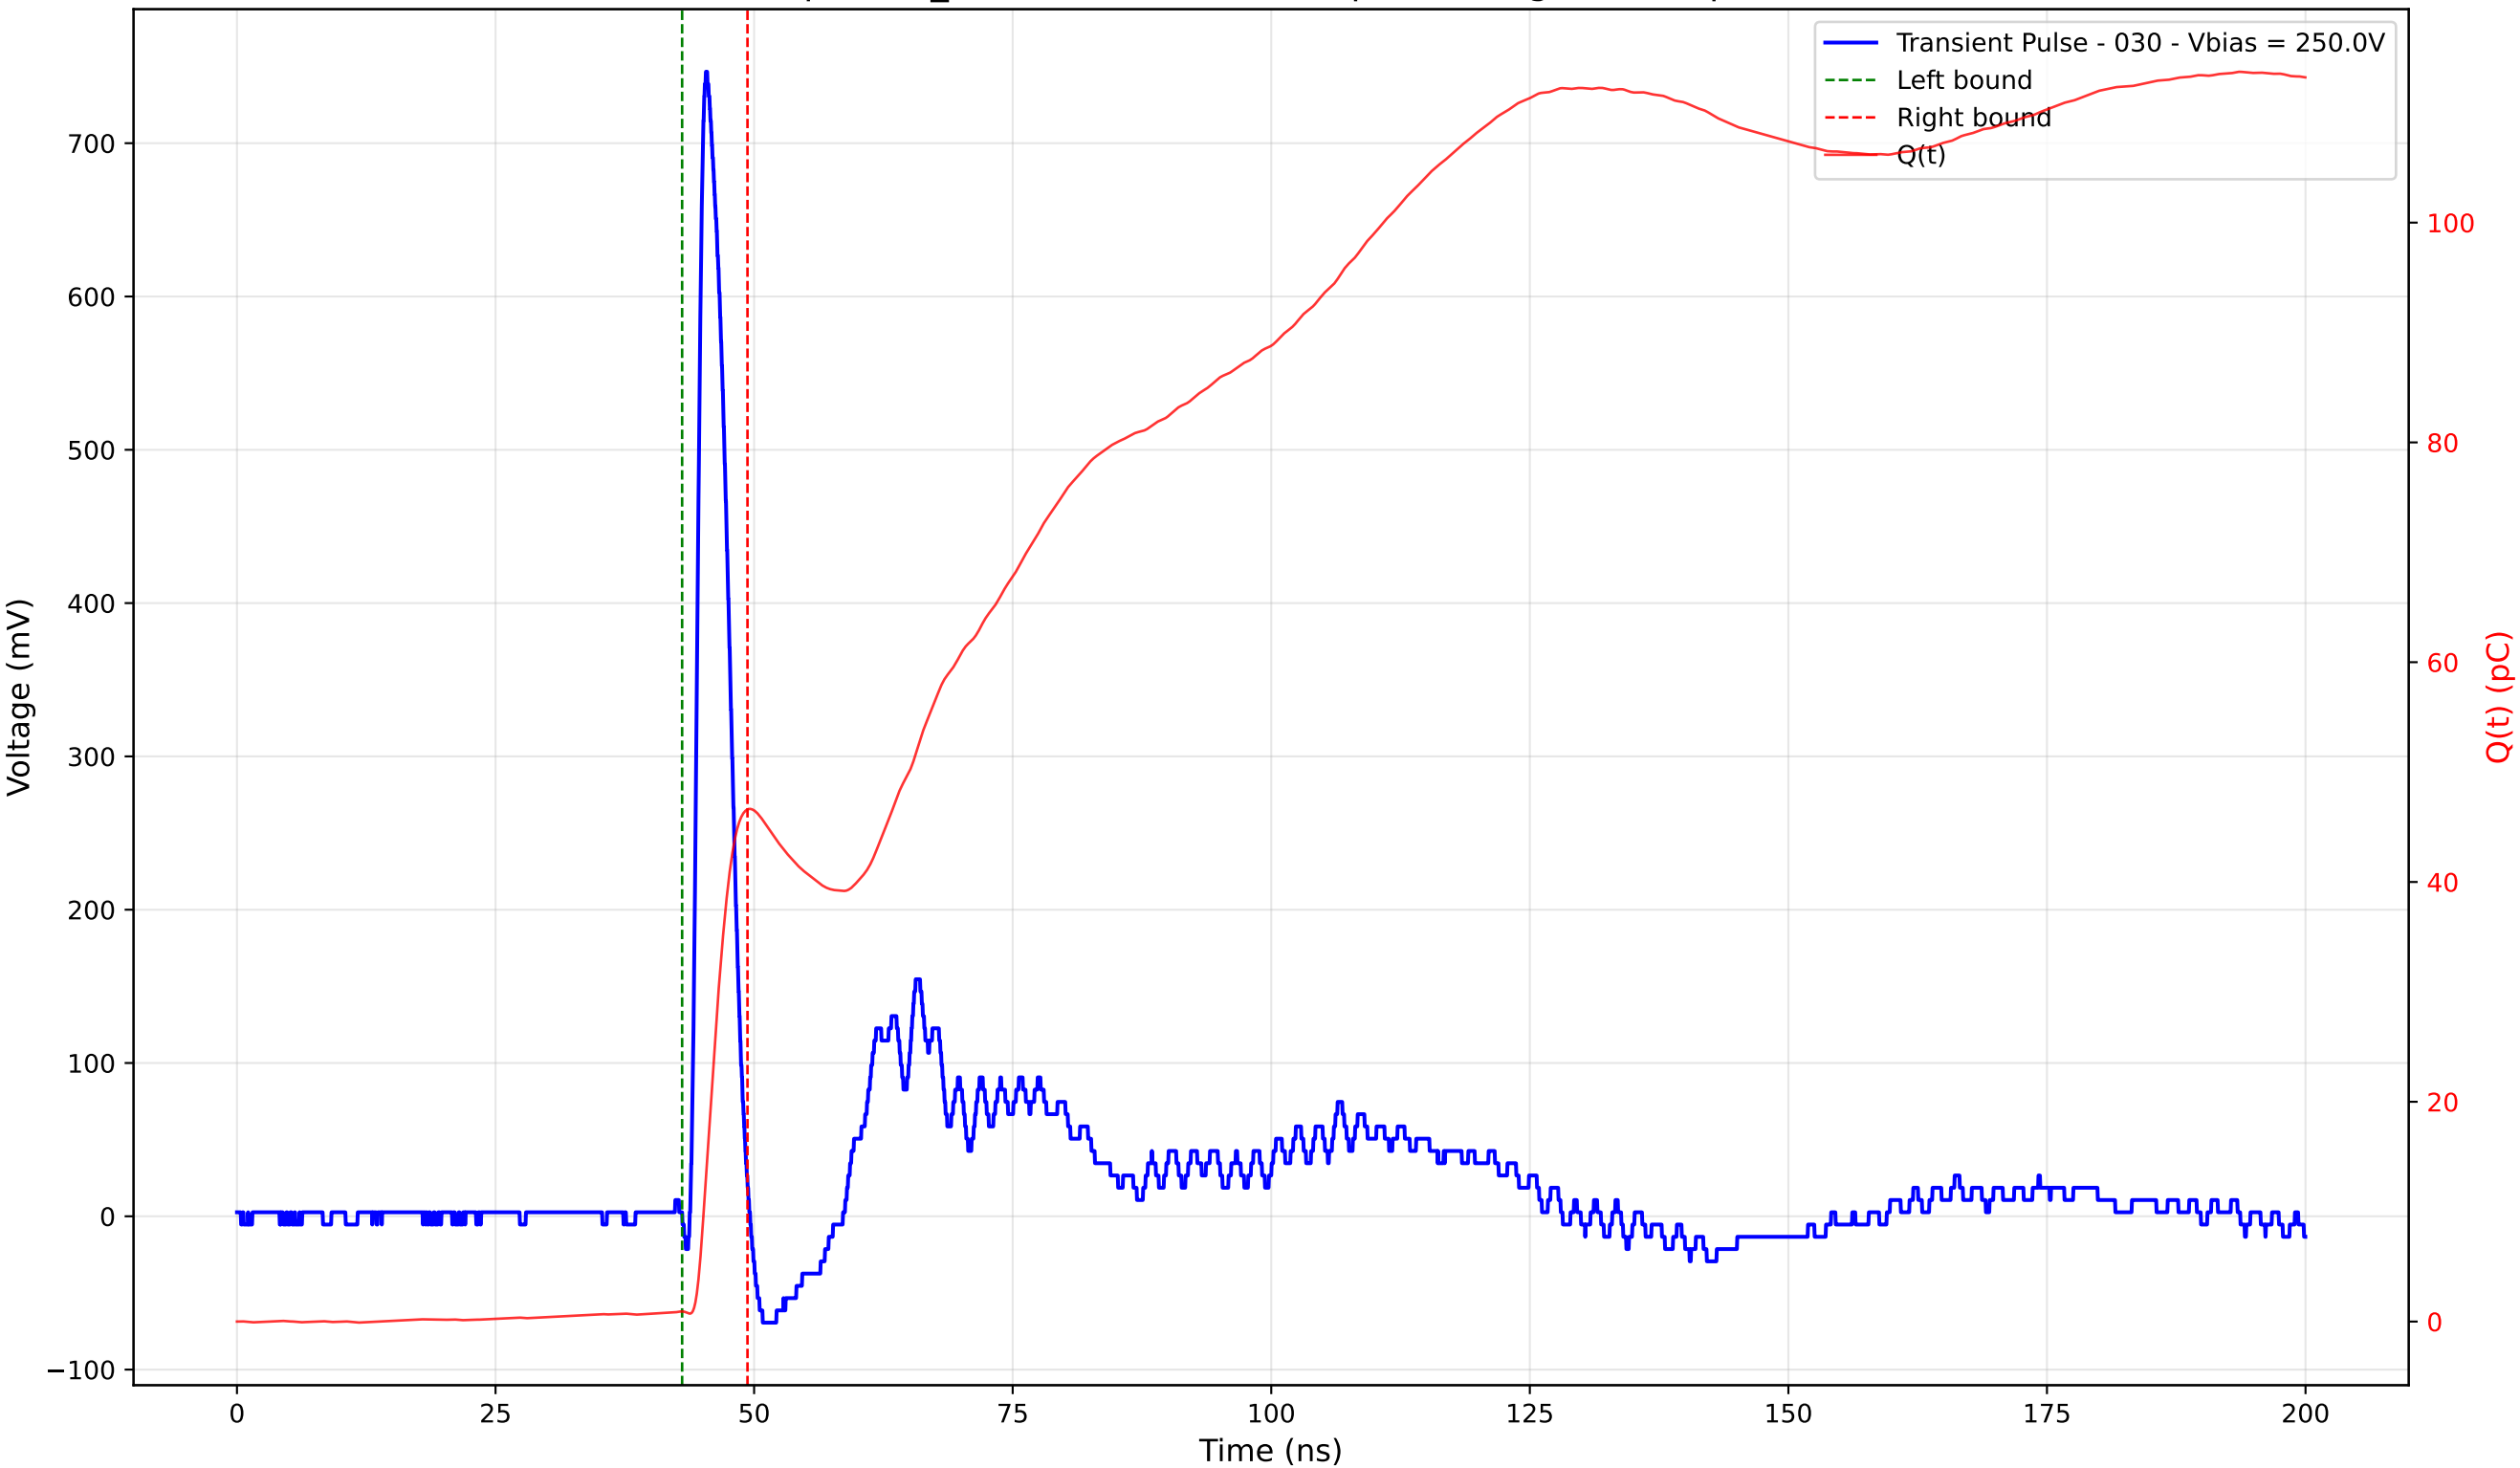


Transient Pulse - Sample: TD_4004 - Position: 285.0 μm - Charge: 45.95 pC - Rise Time: 0.95 ns

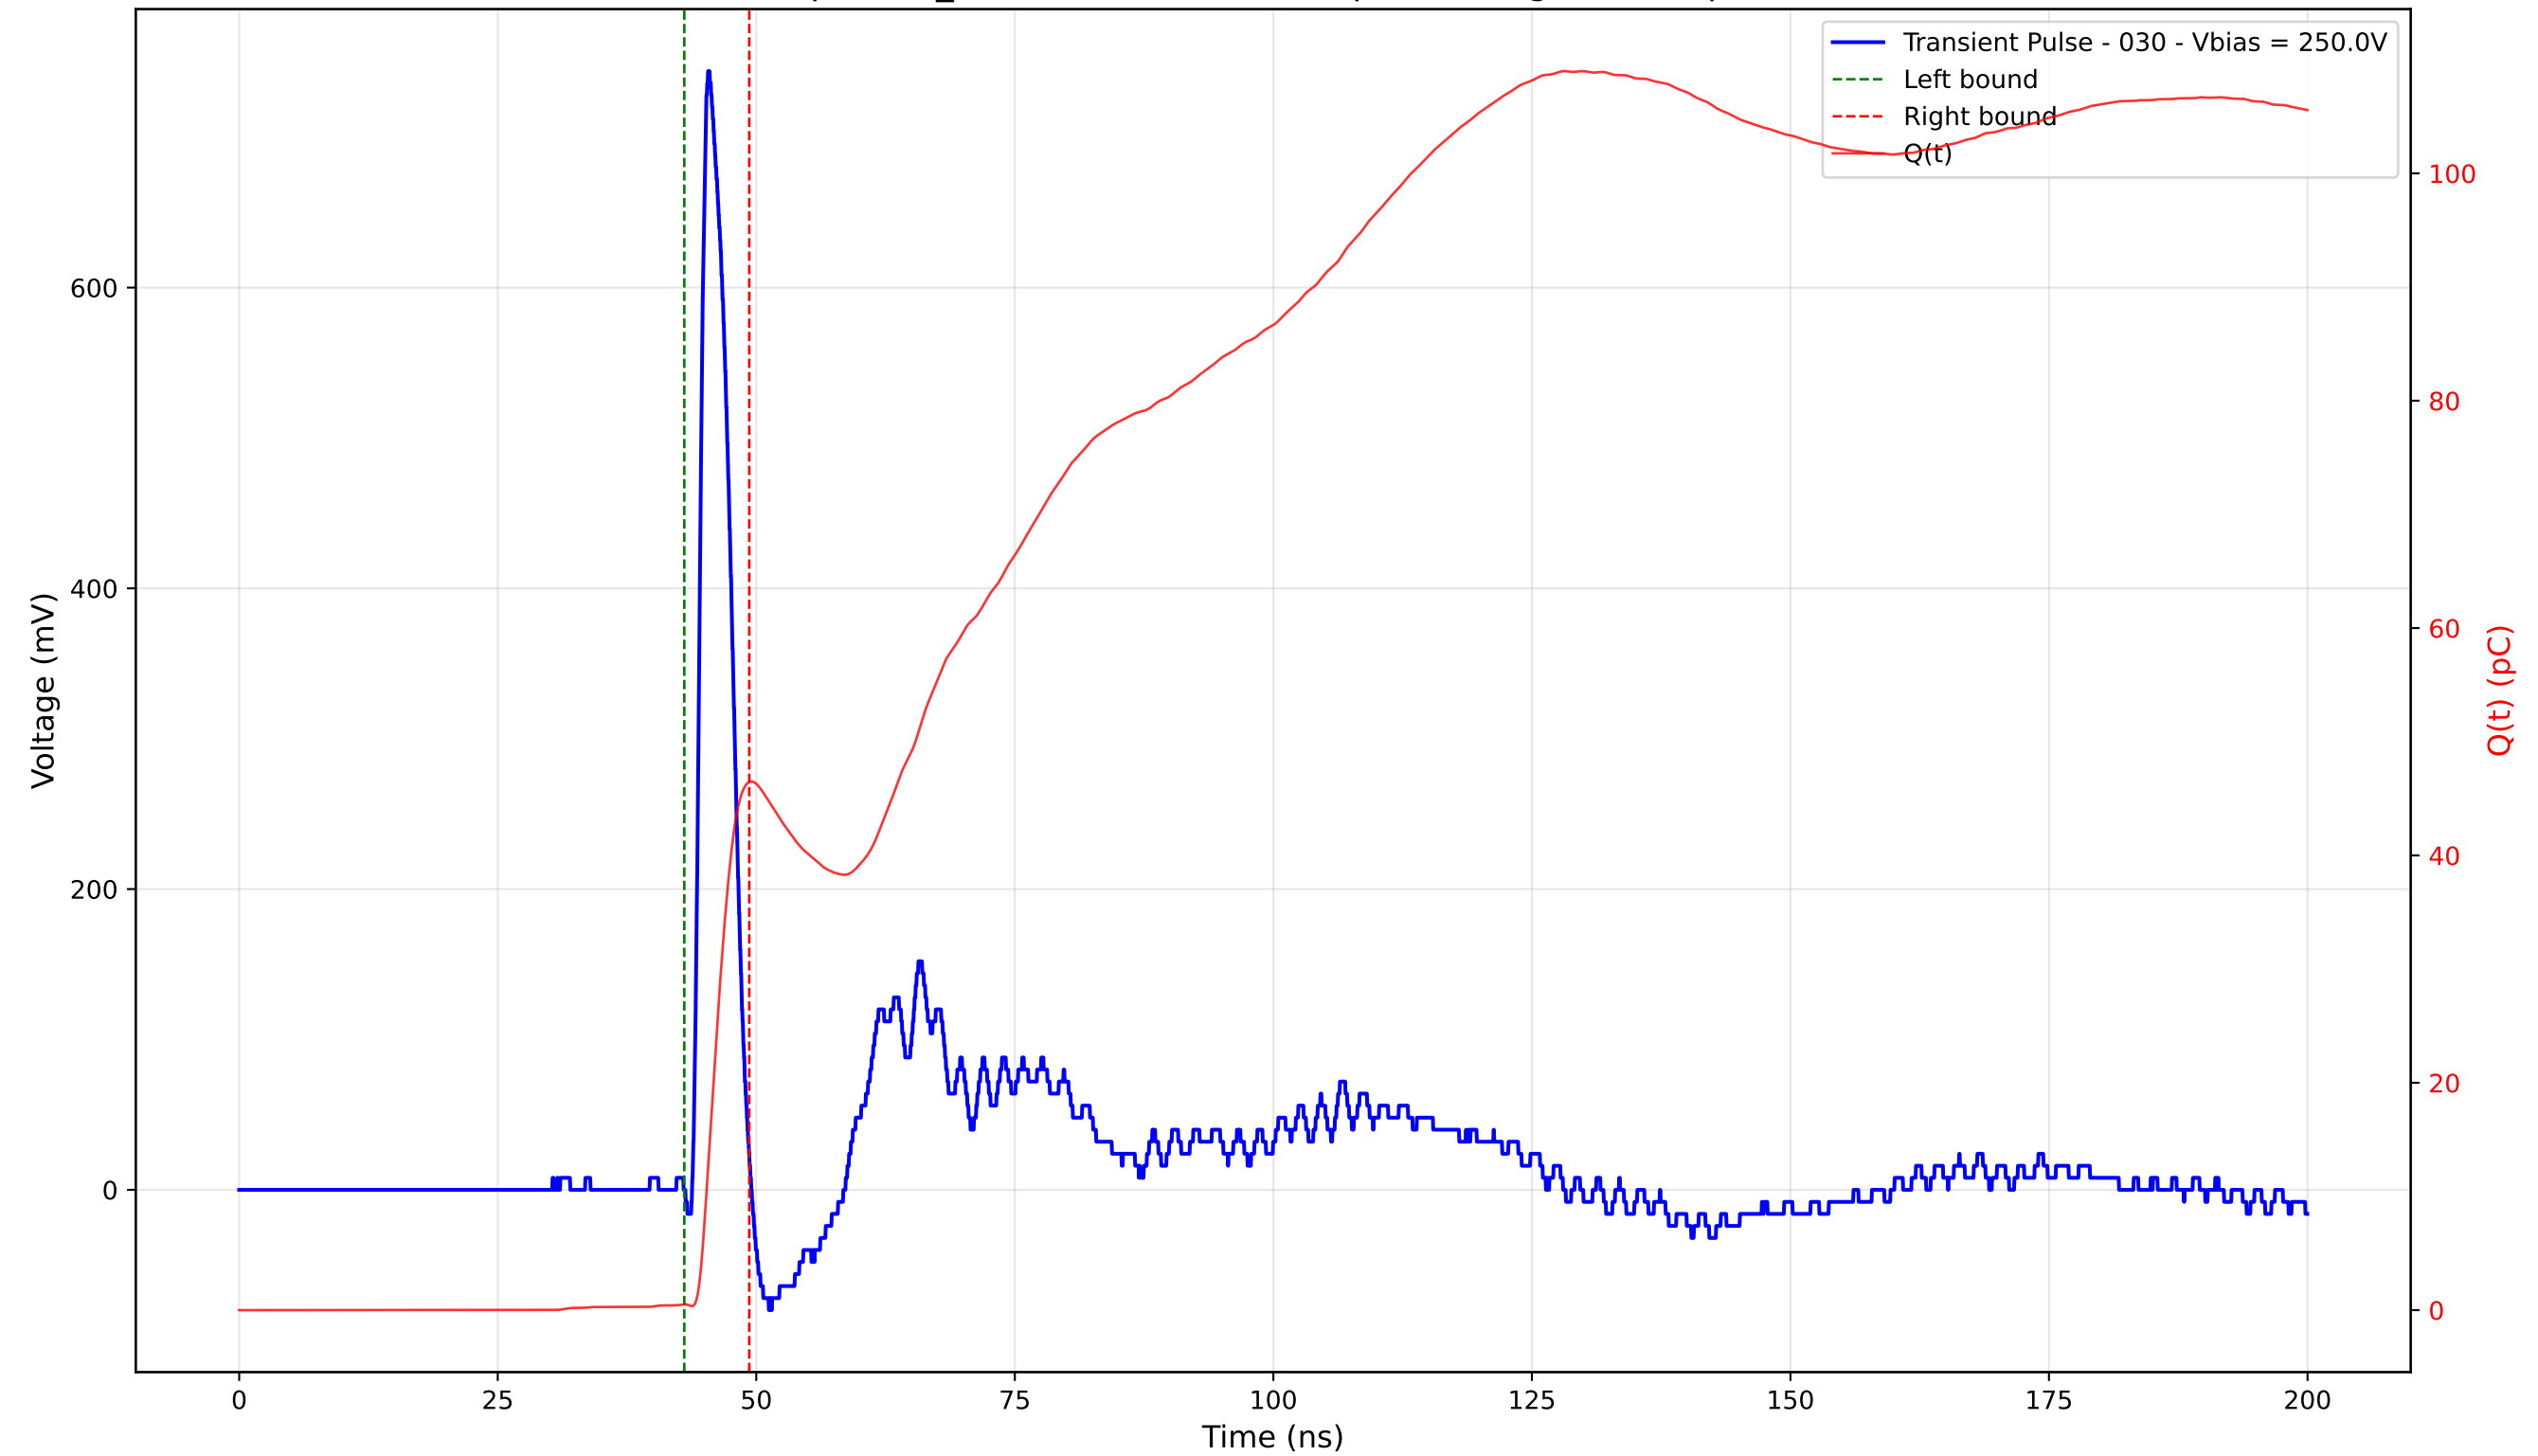


Transient Pulse - Sample: TD_4004 - Position: 290.0 μm - Charge: 45.78 pC - Rise Time: 0.96 ns

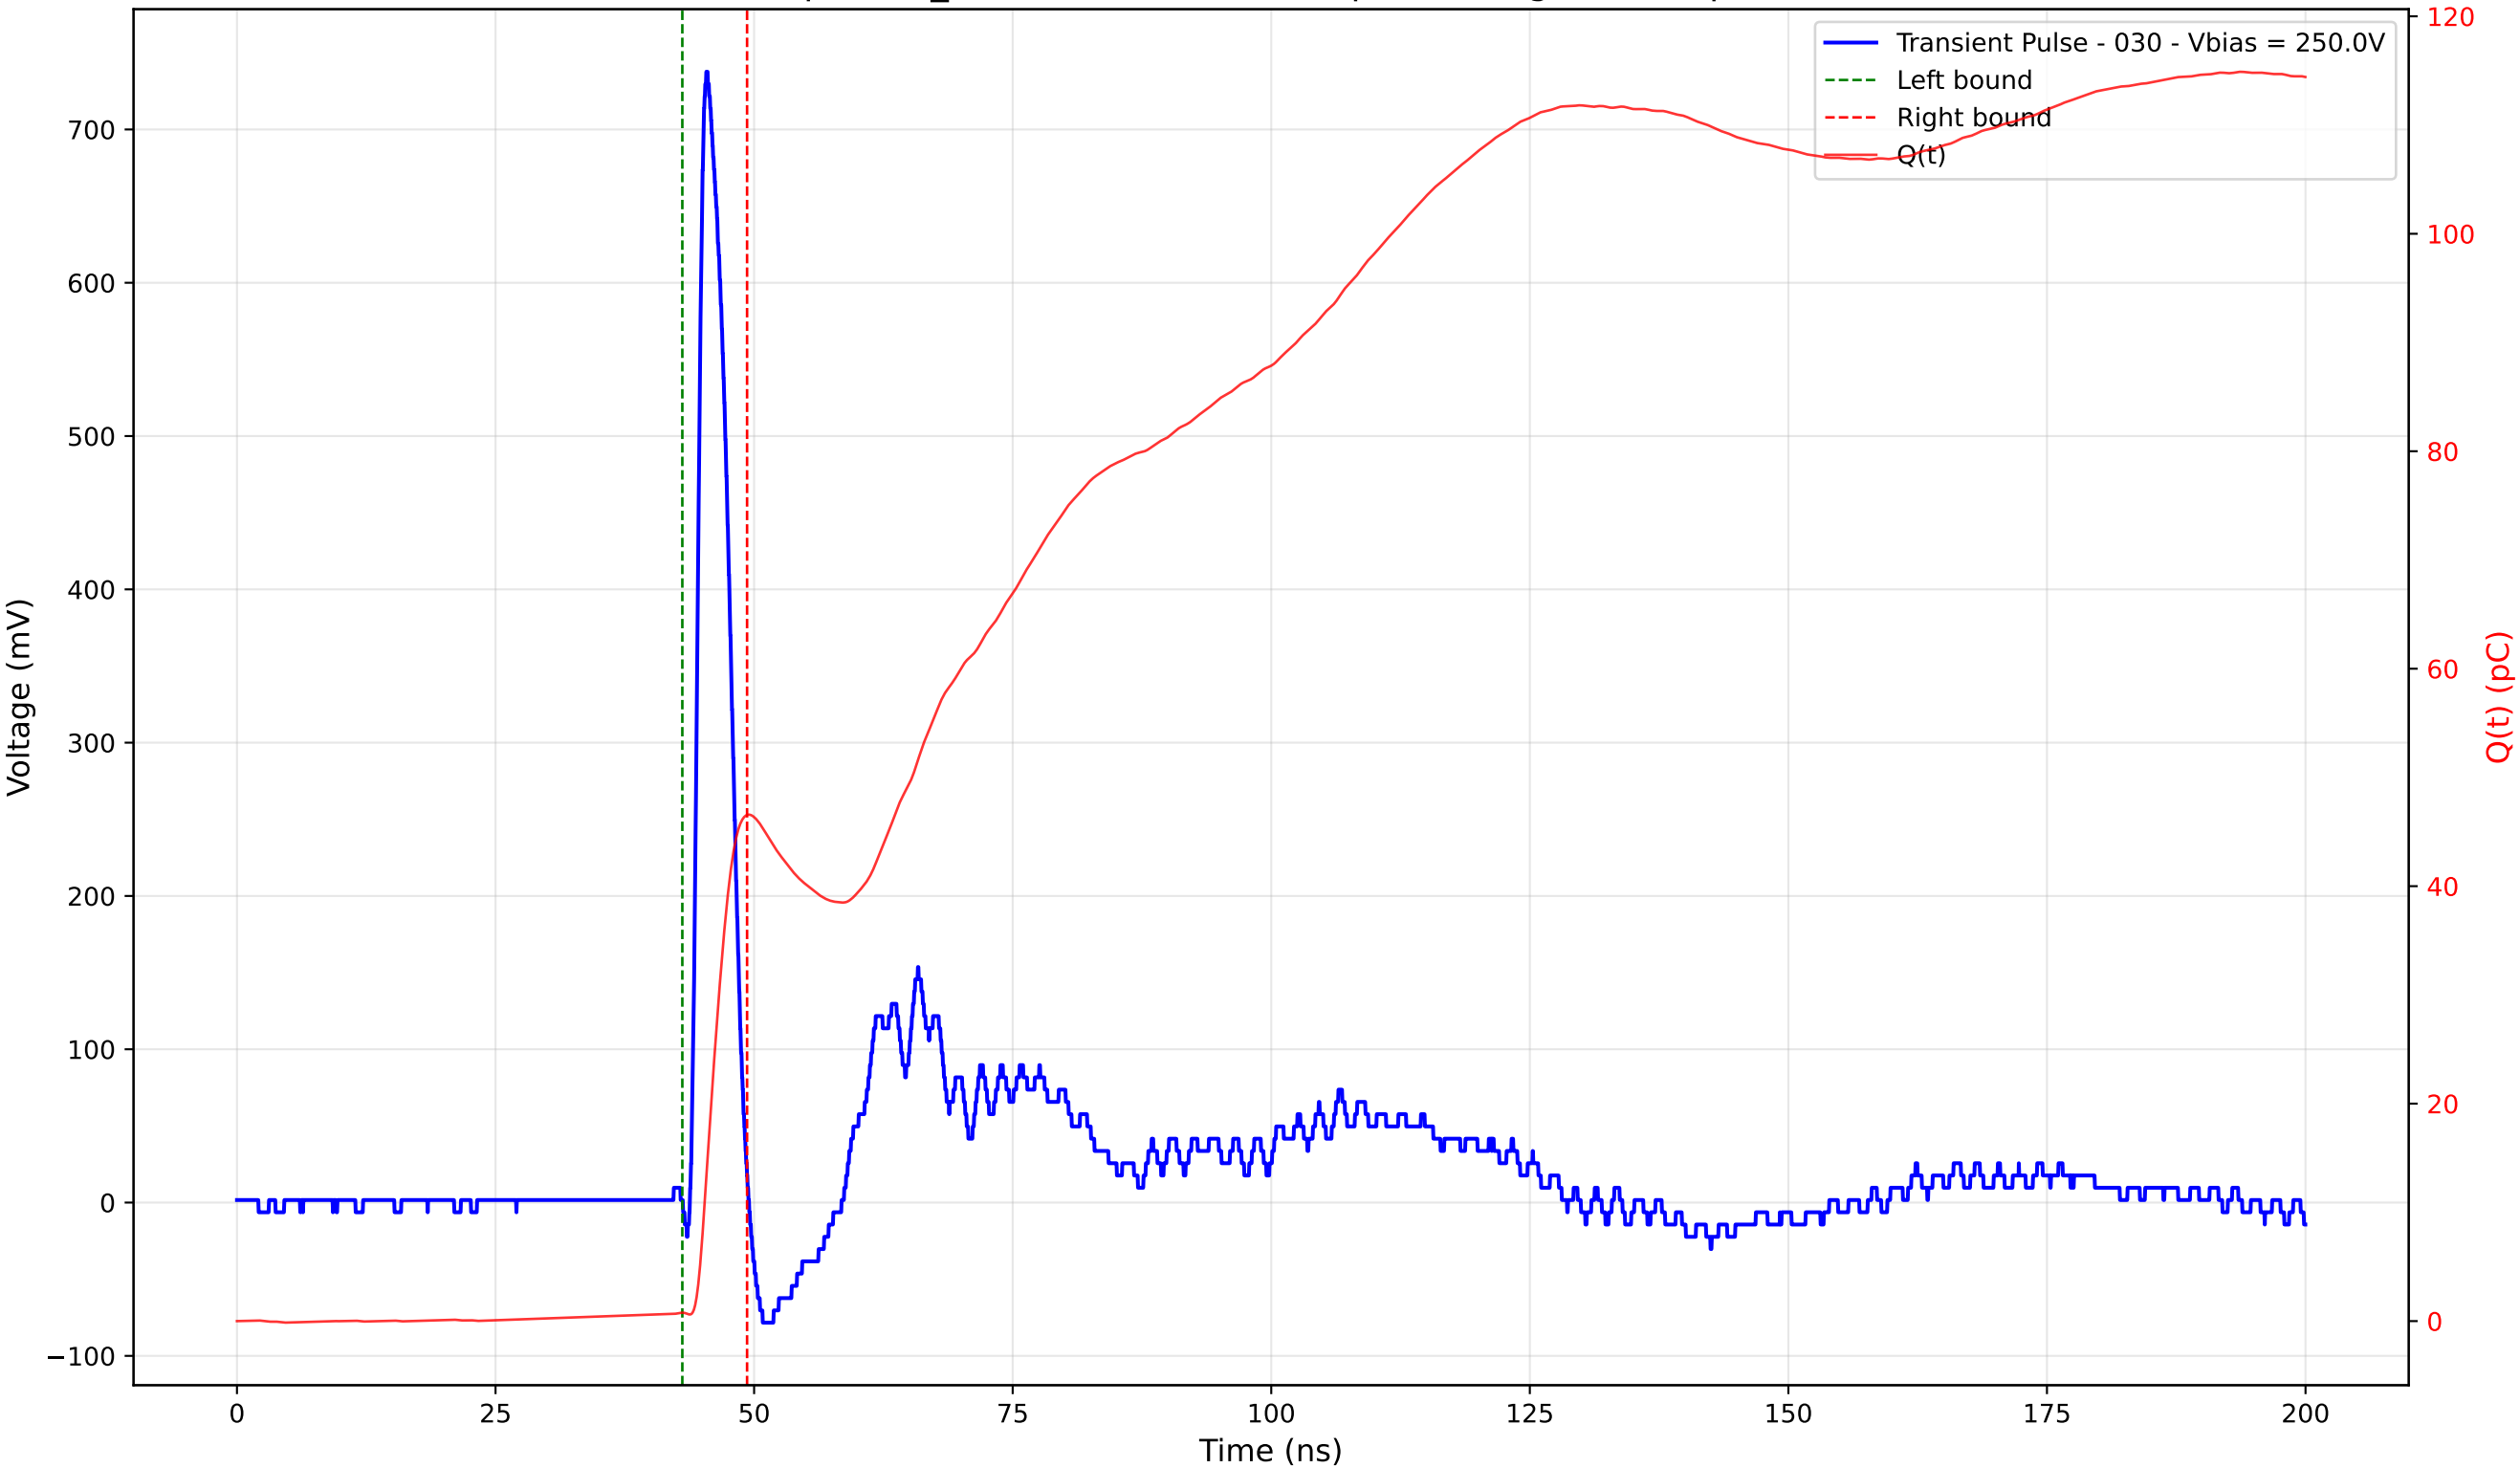


Transient Pulse - Sample: TD_4004 - Position: 295.0 μm - Charge: 44.82 pC - Rise Time: 0.96 ns

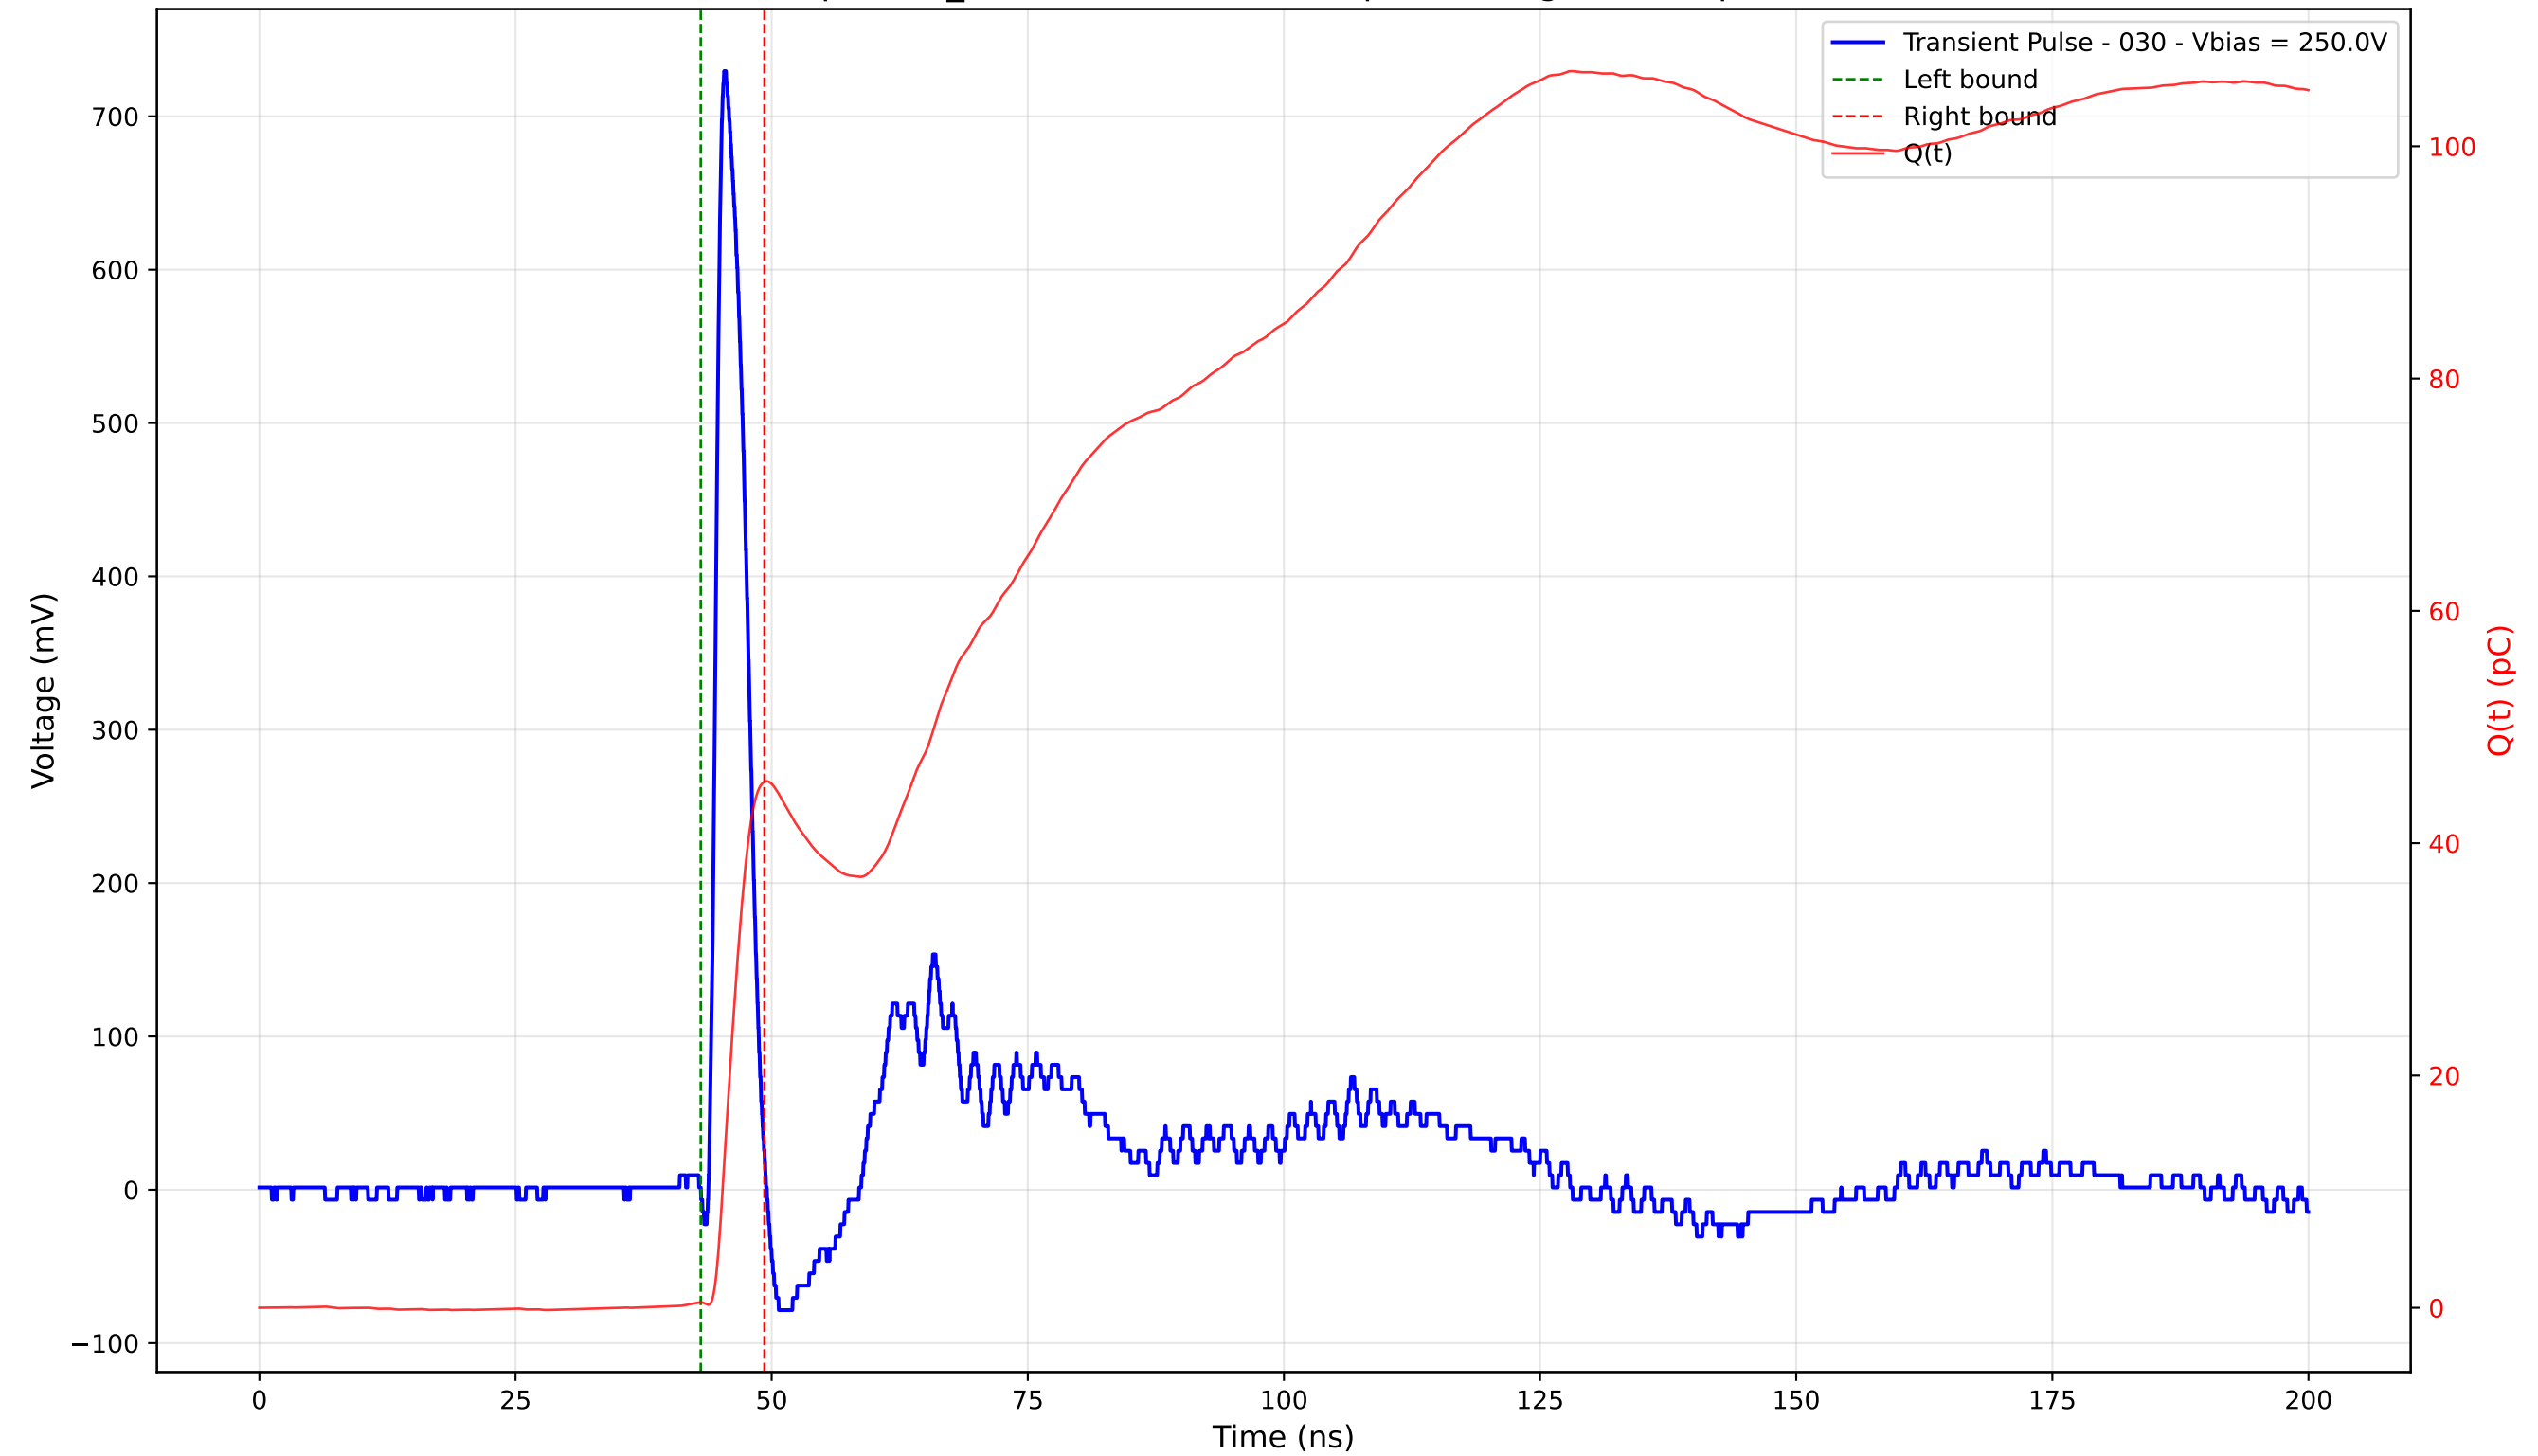


Transient Pulse - Sample: TD_4004 - Position: 300.0 μm - Charge: 44.56 pC - Rise Time: 0.97 ns

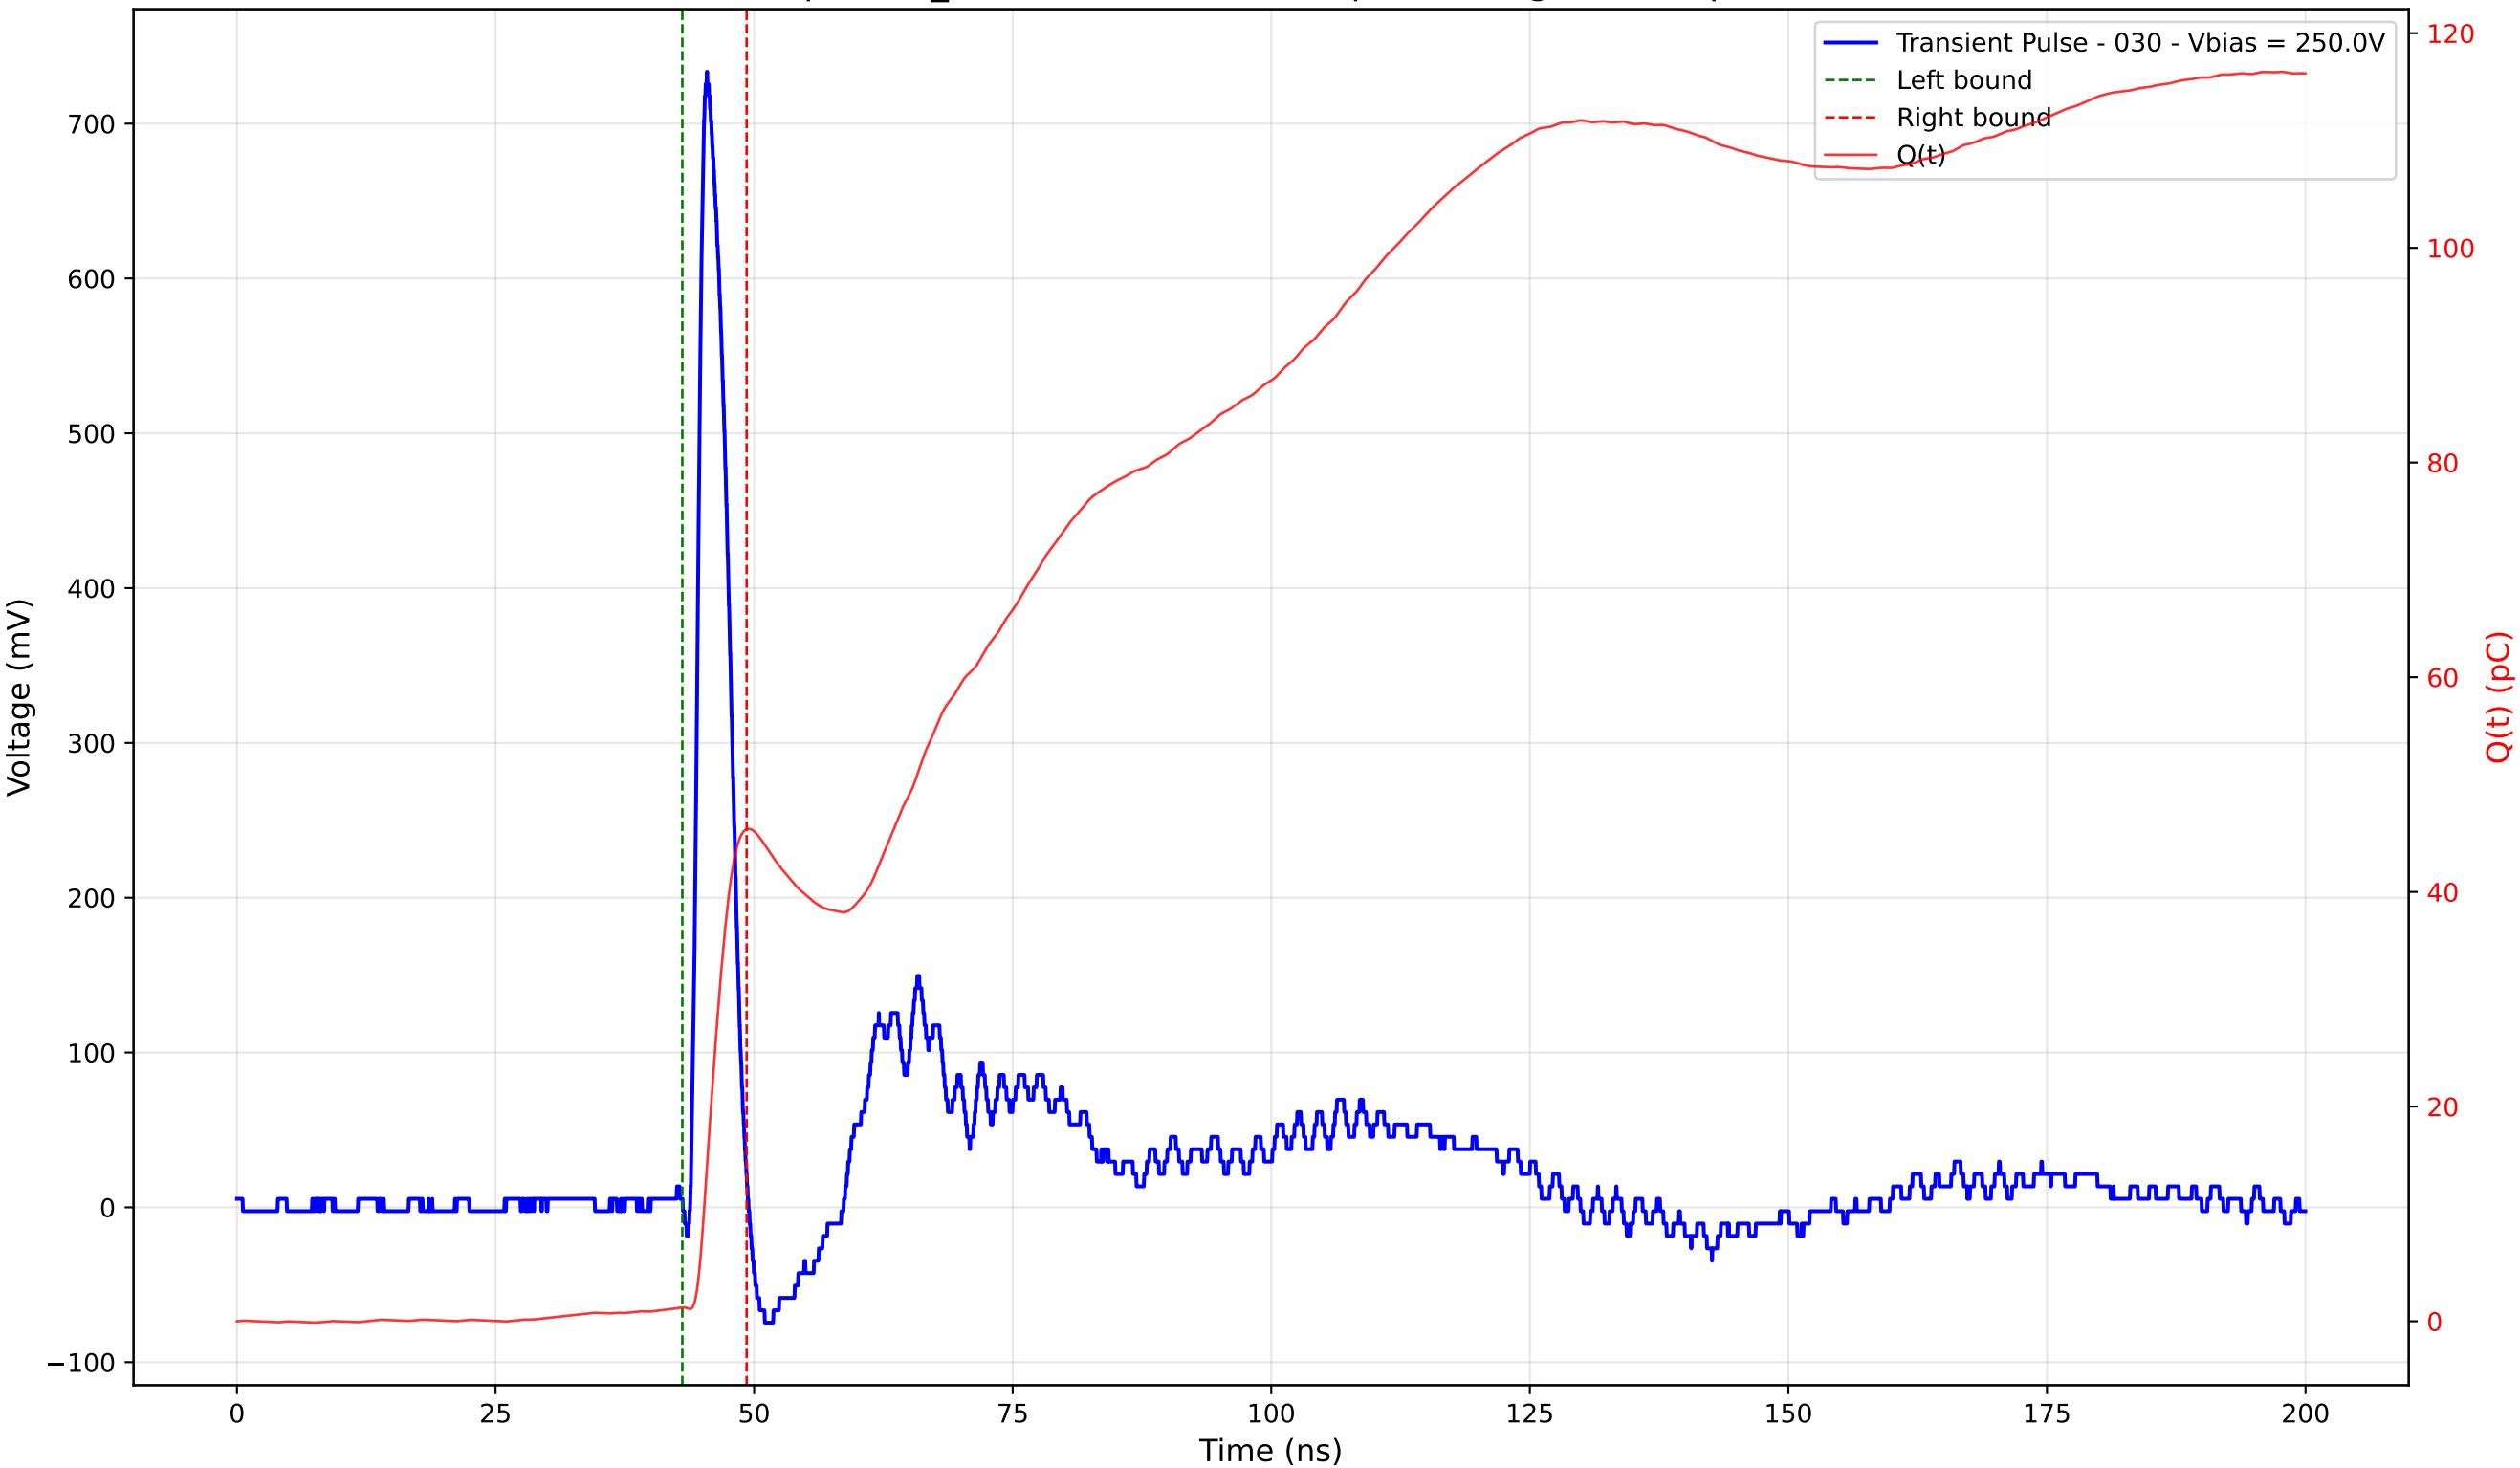


Transient Pulse - Sample: TD_4004 - Position: 305.0 μm - Charge: 43.30 pC - Rise Time: 0.96 ns

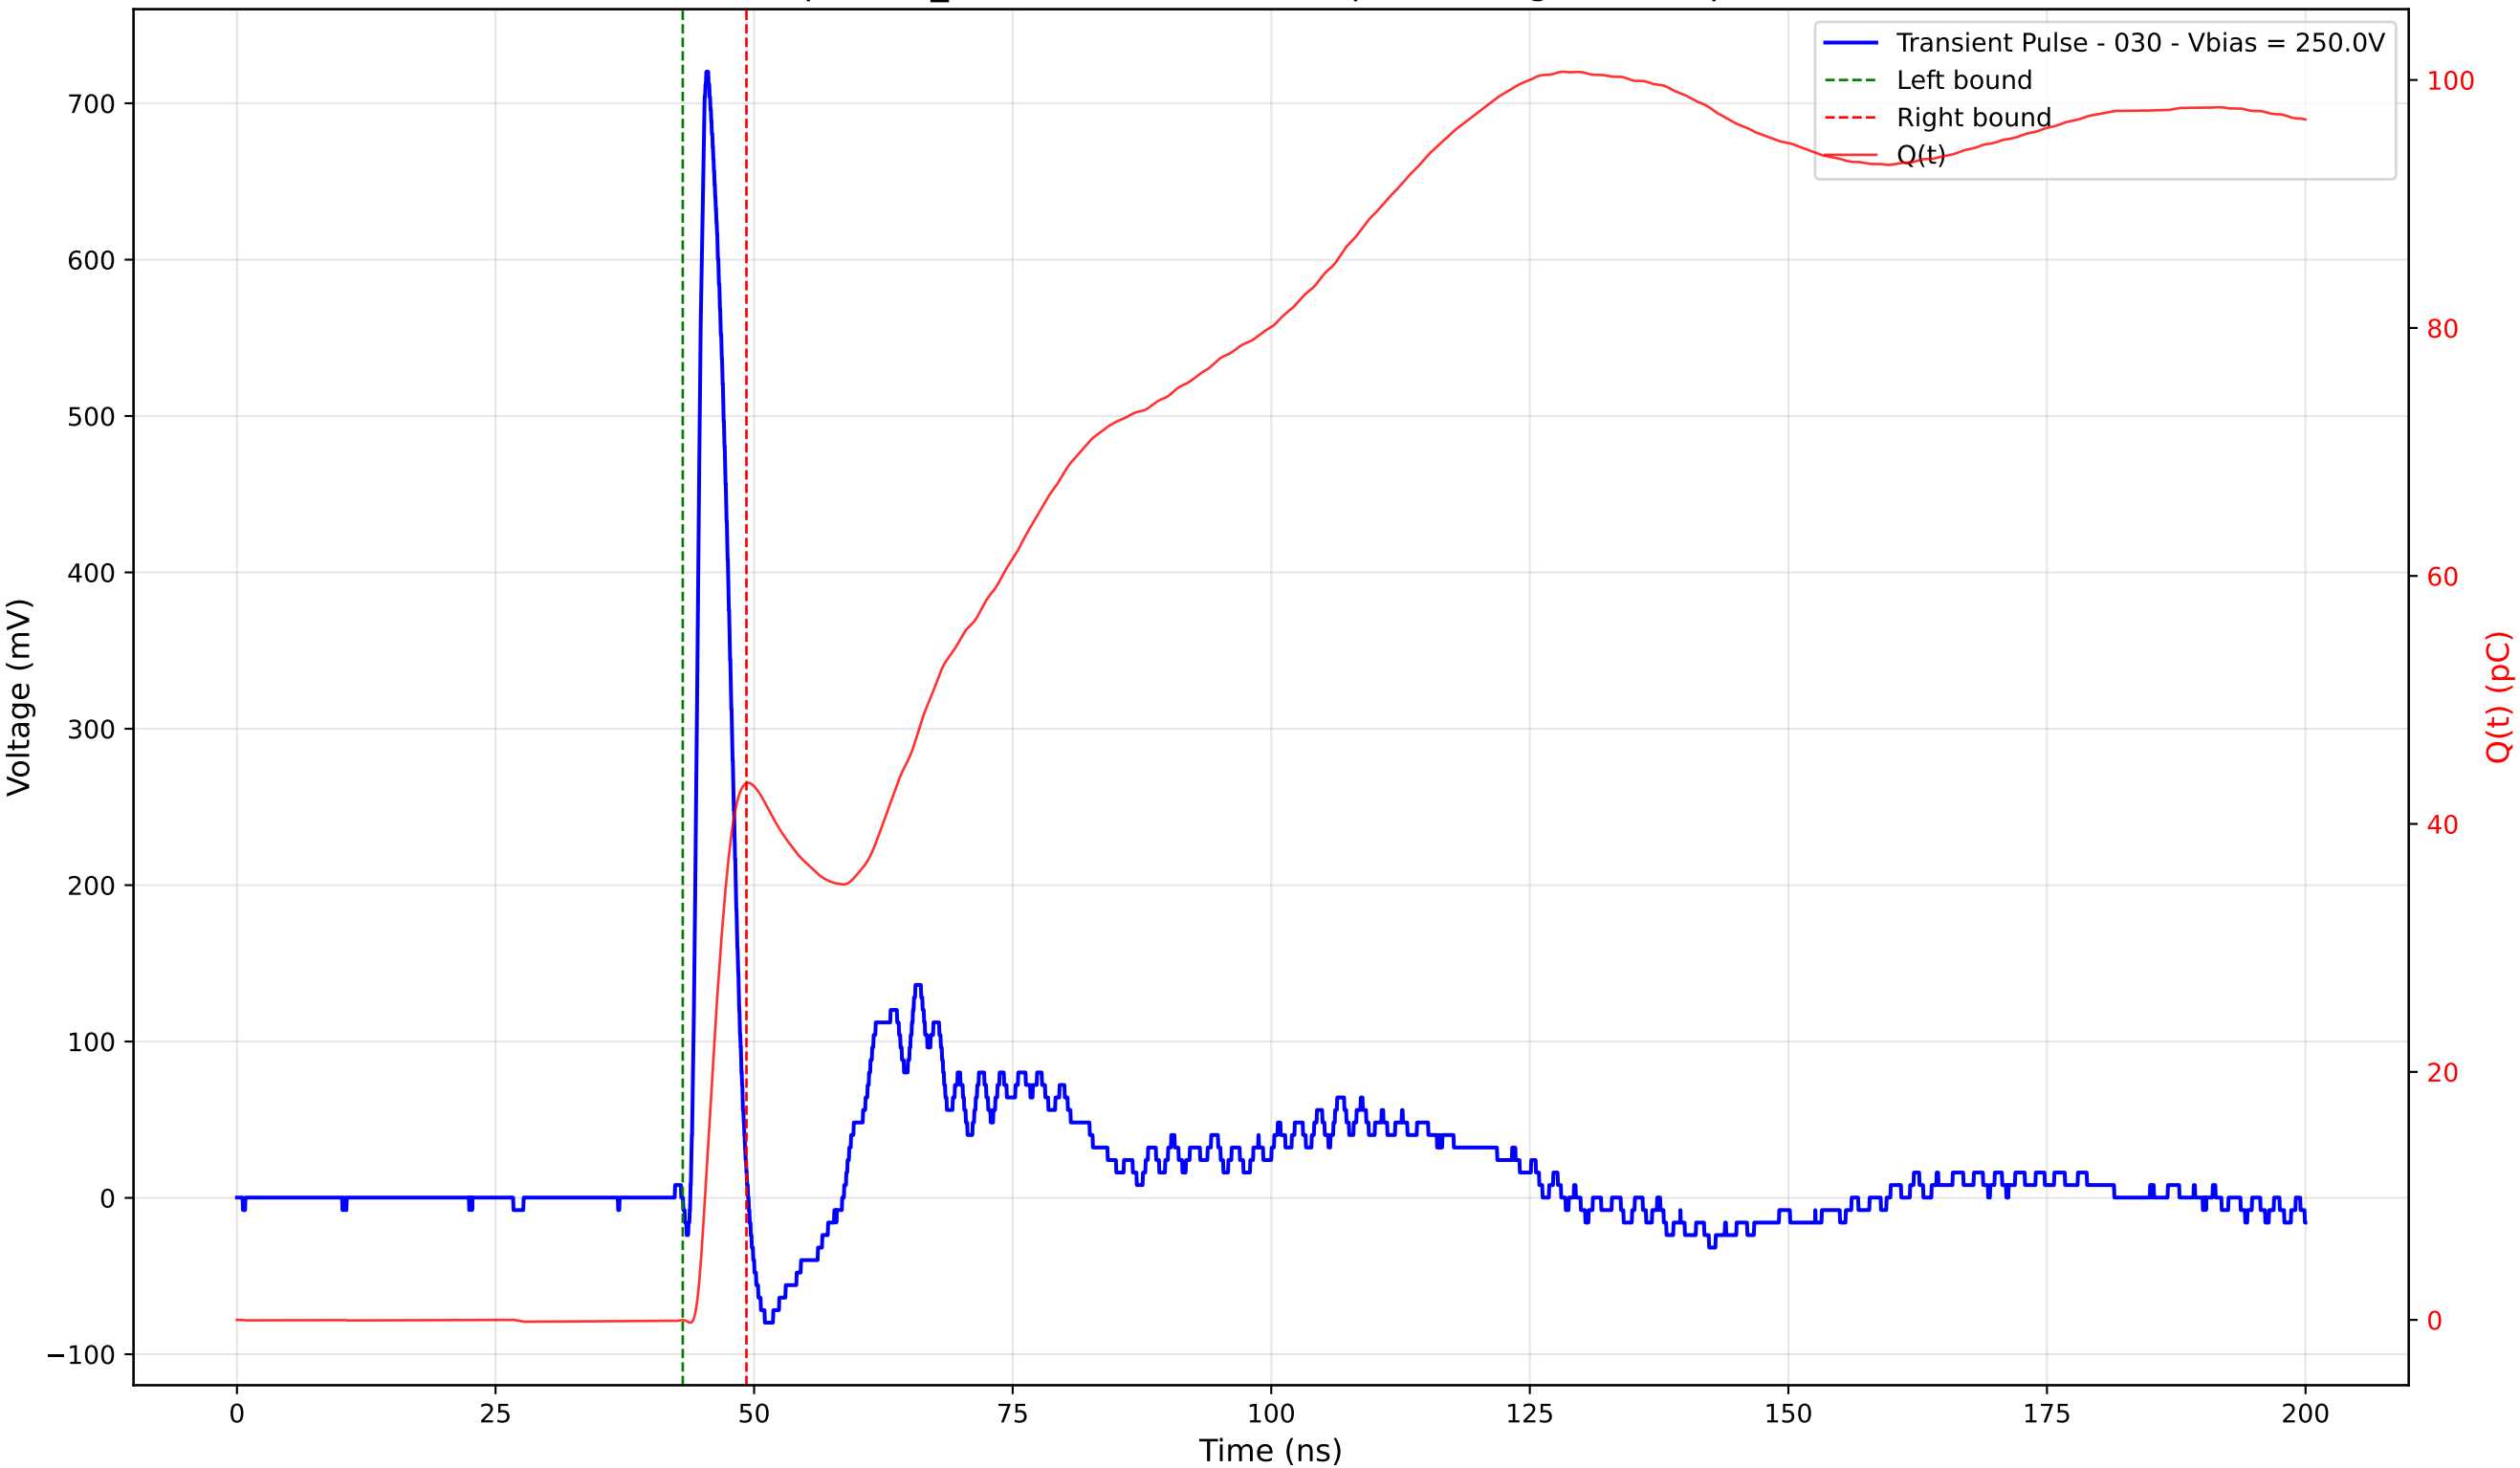


Transient Pulse - Sample: TD_4004 - Position: 310.0 μm - Charge: 42.27 pC - Rise Time: 0.97 ns

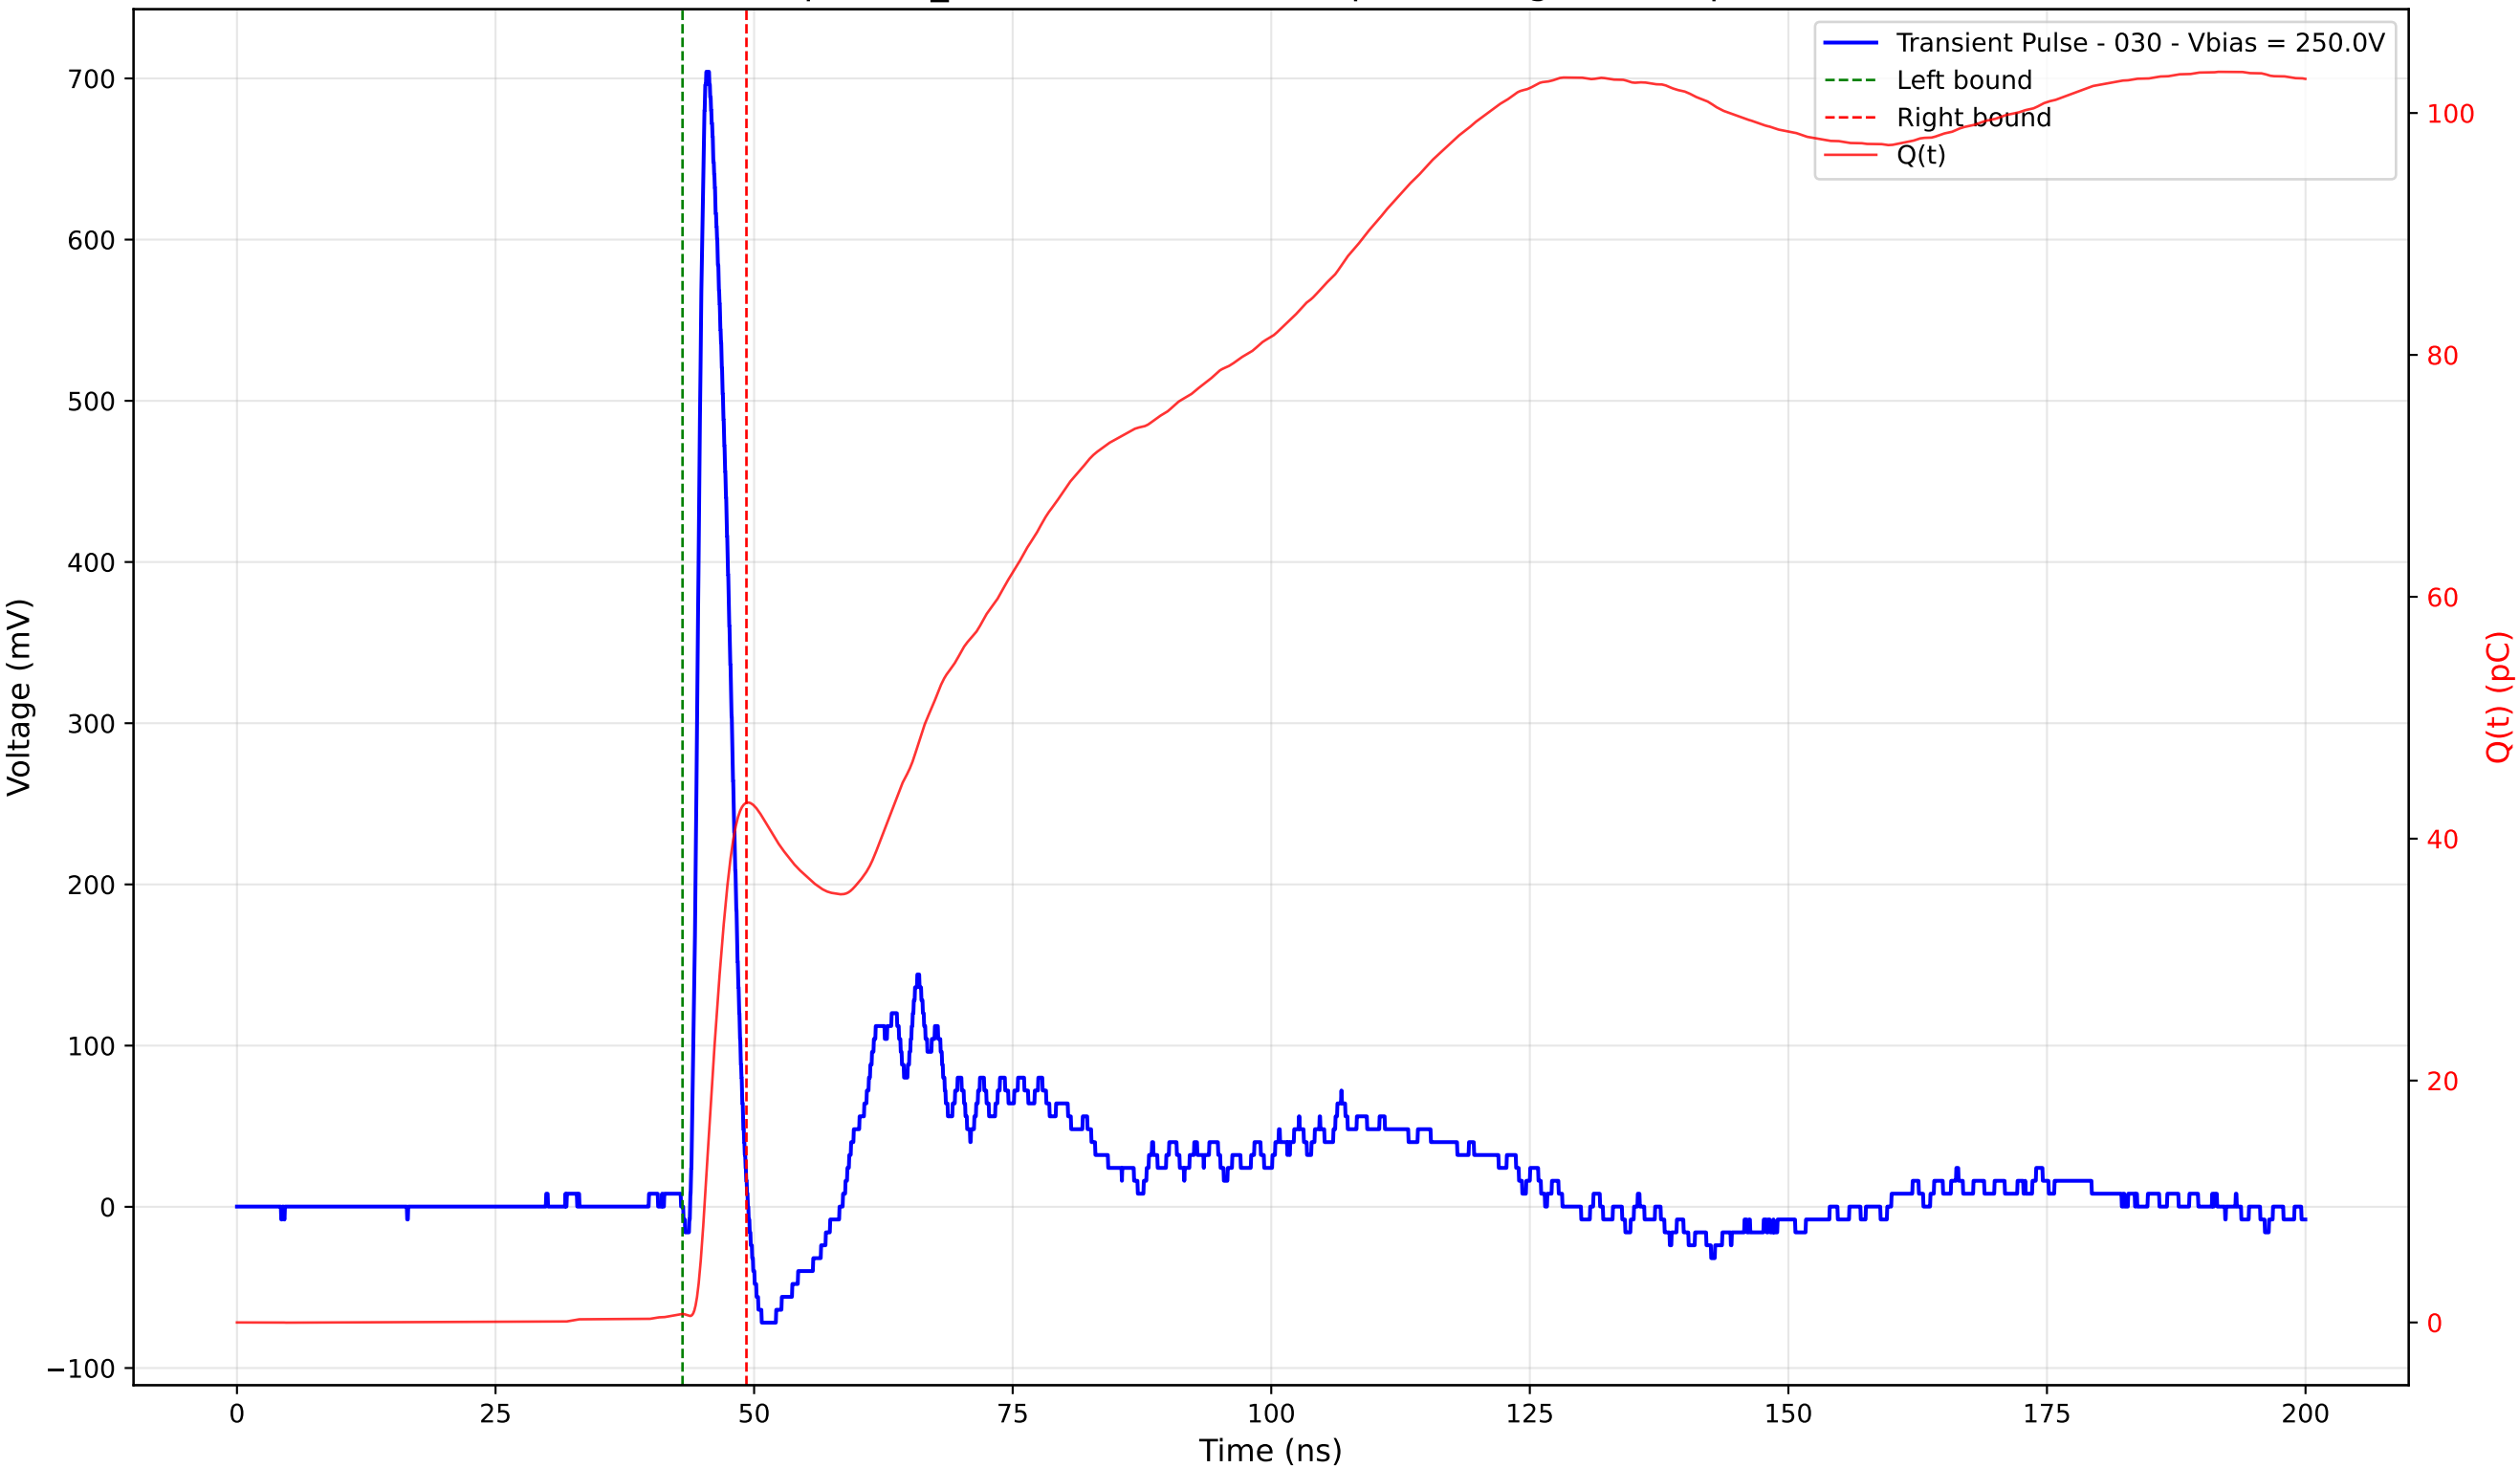


Transient Pulse - Sample: TD_4004 - Position: 315.0 μm - Charge: 40.99 pC - Rise Time: 1.00 ns

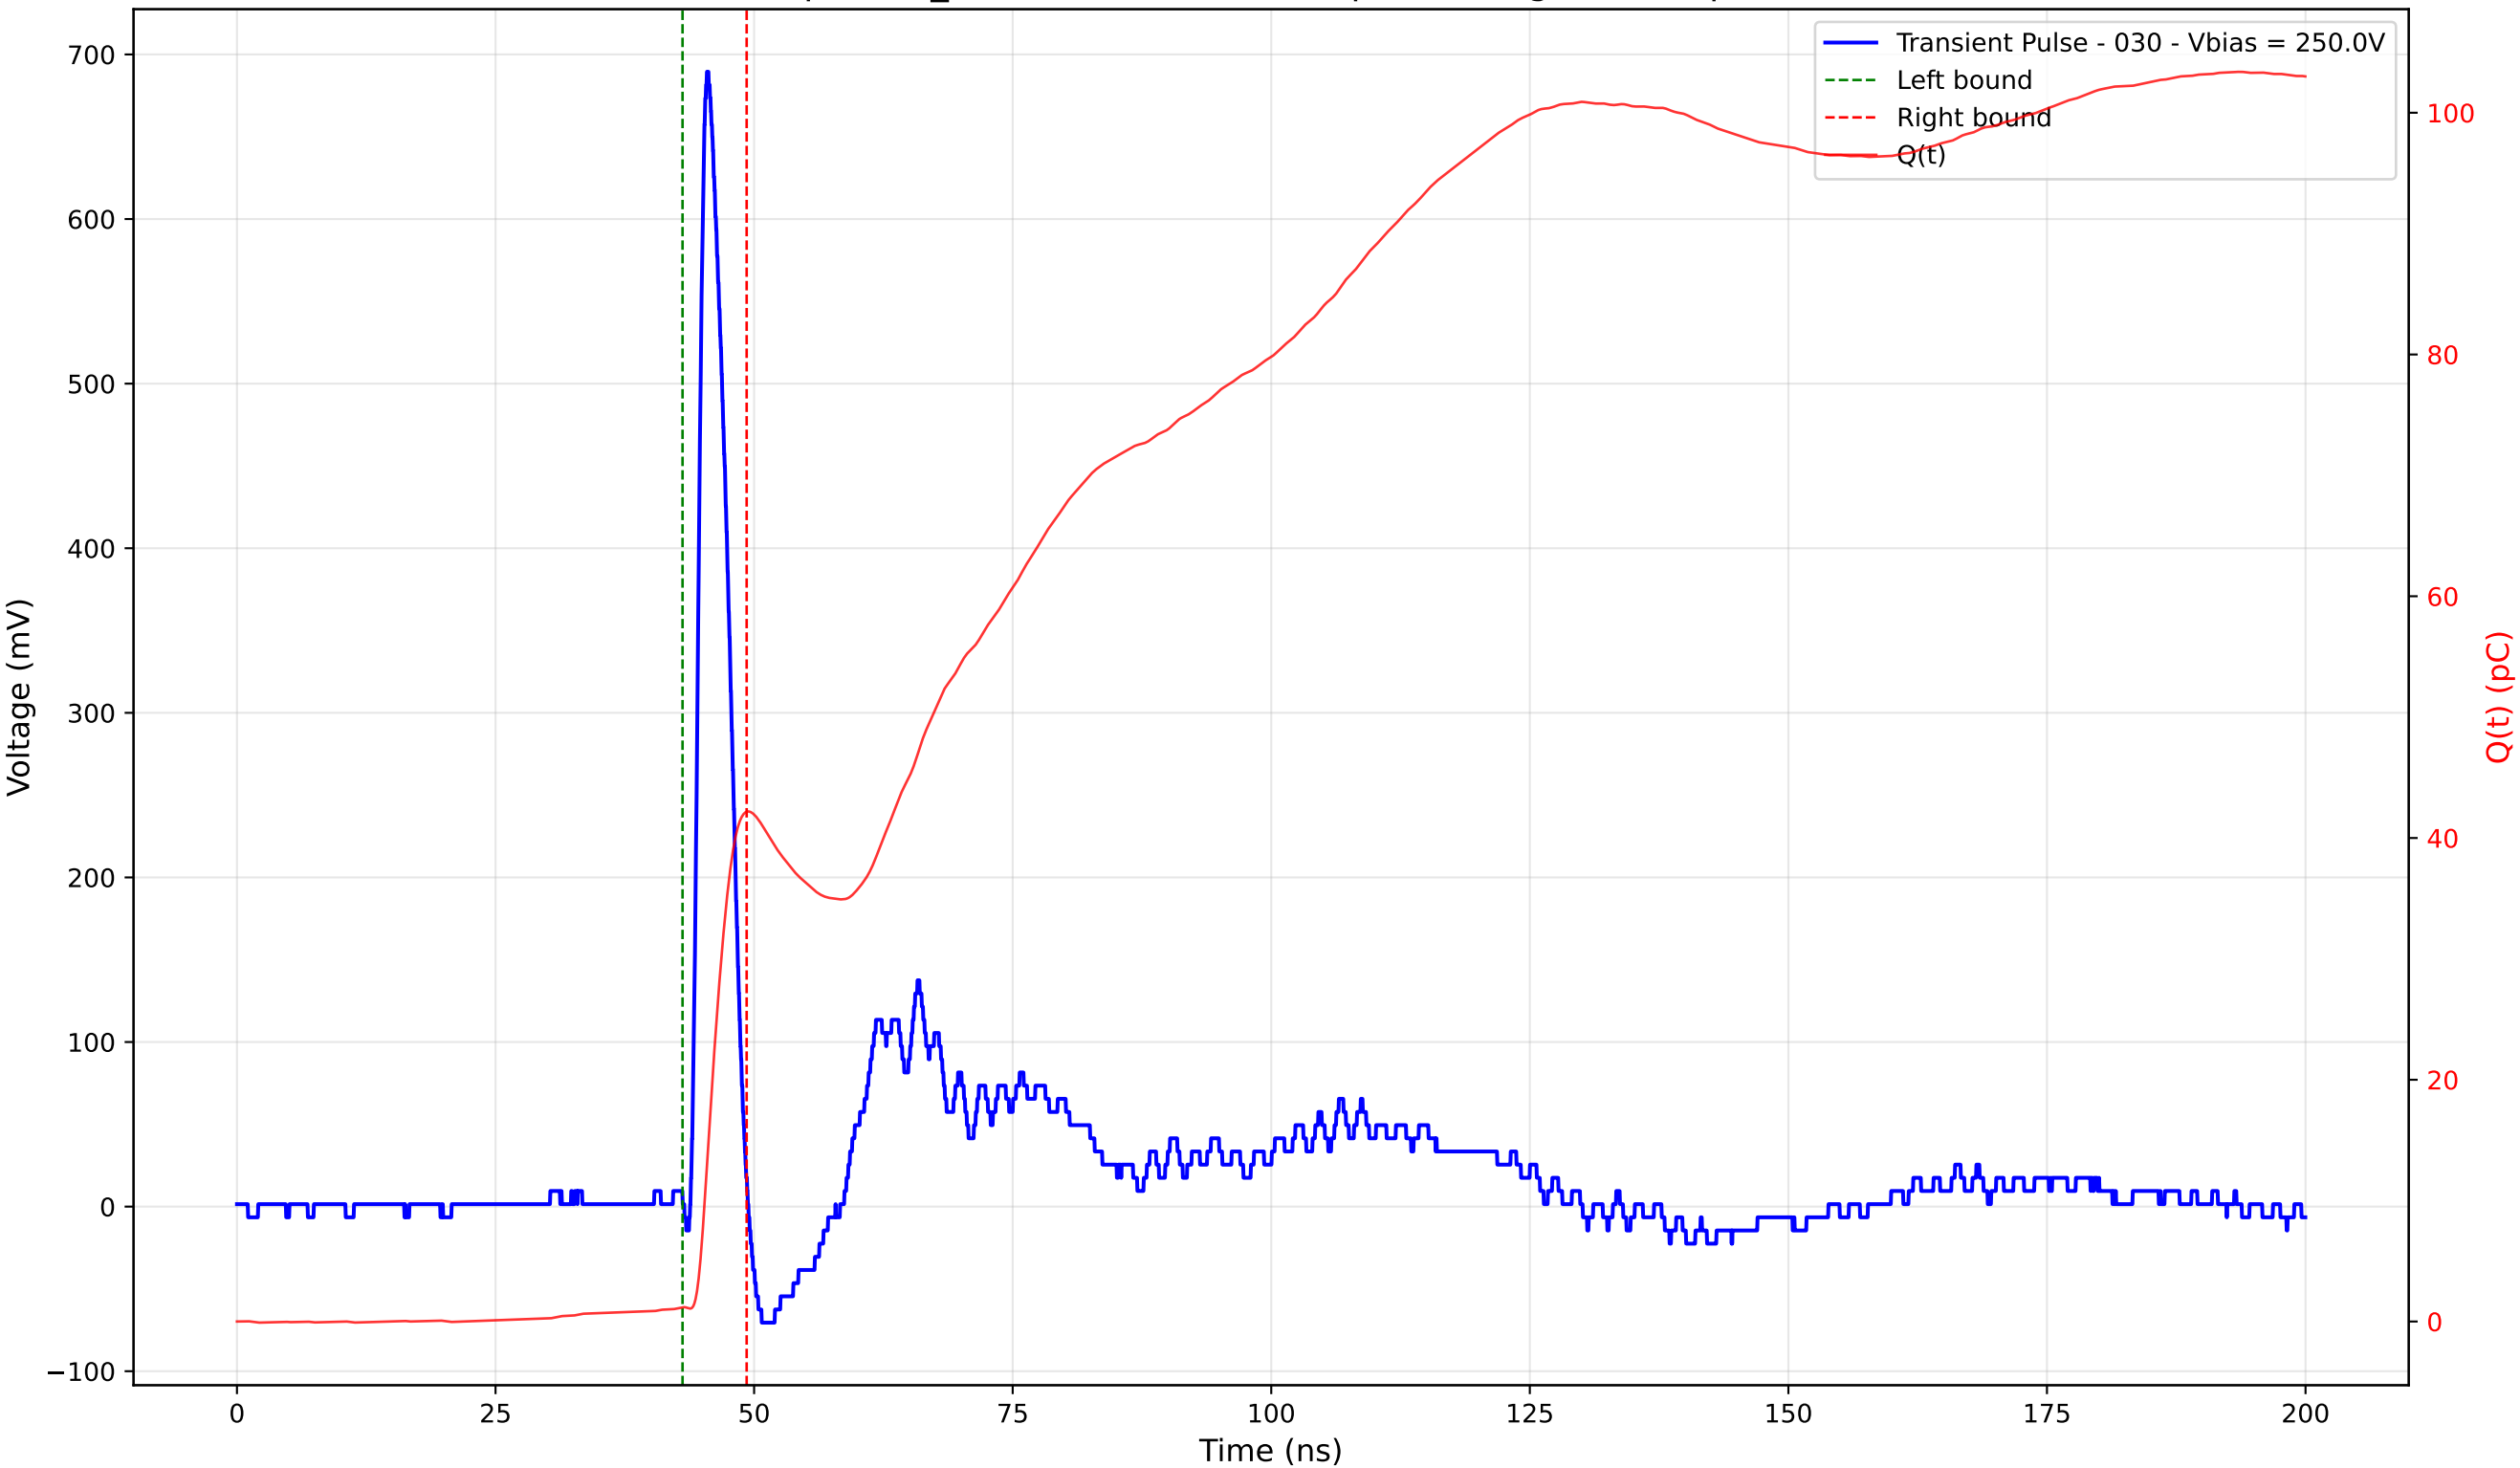


Transient Pulse - Sample: TD_4004 - Position: 320.0 μm - Charge: 40.29 pC - Rise Time: 1.01 ns

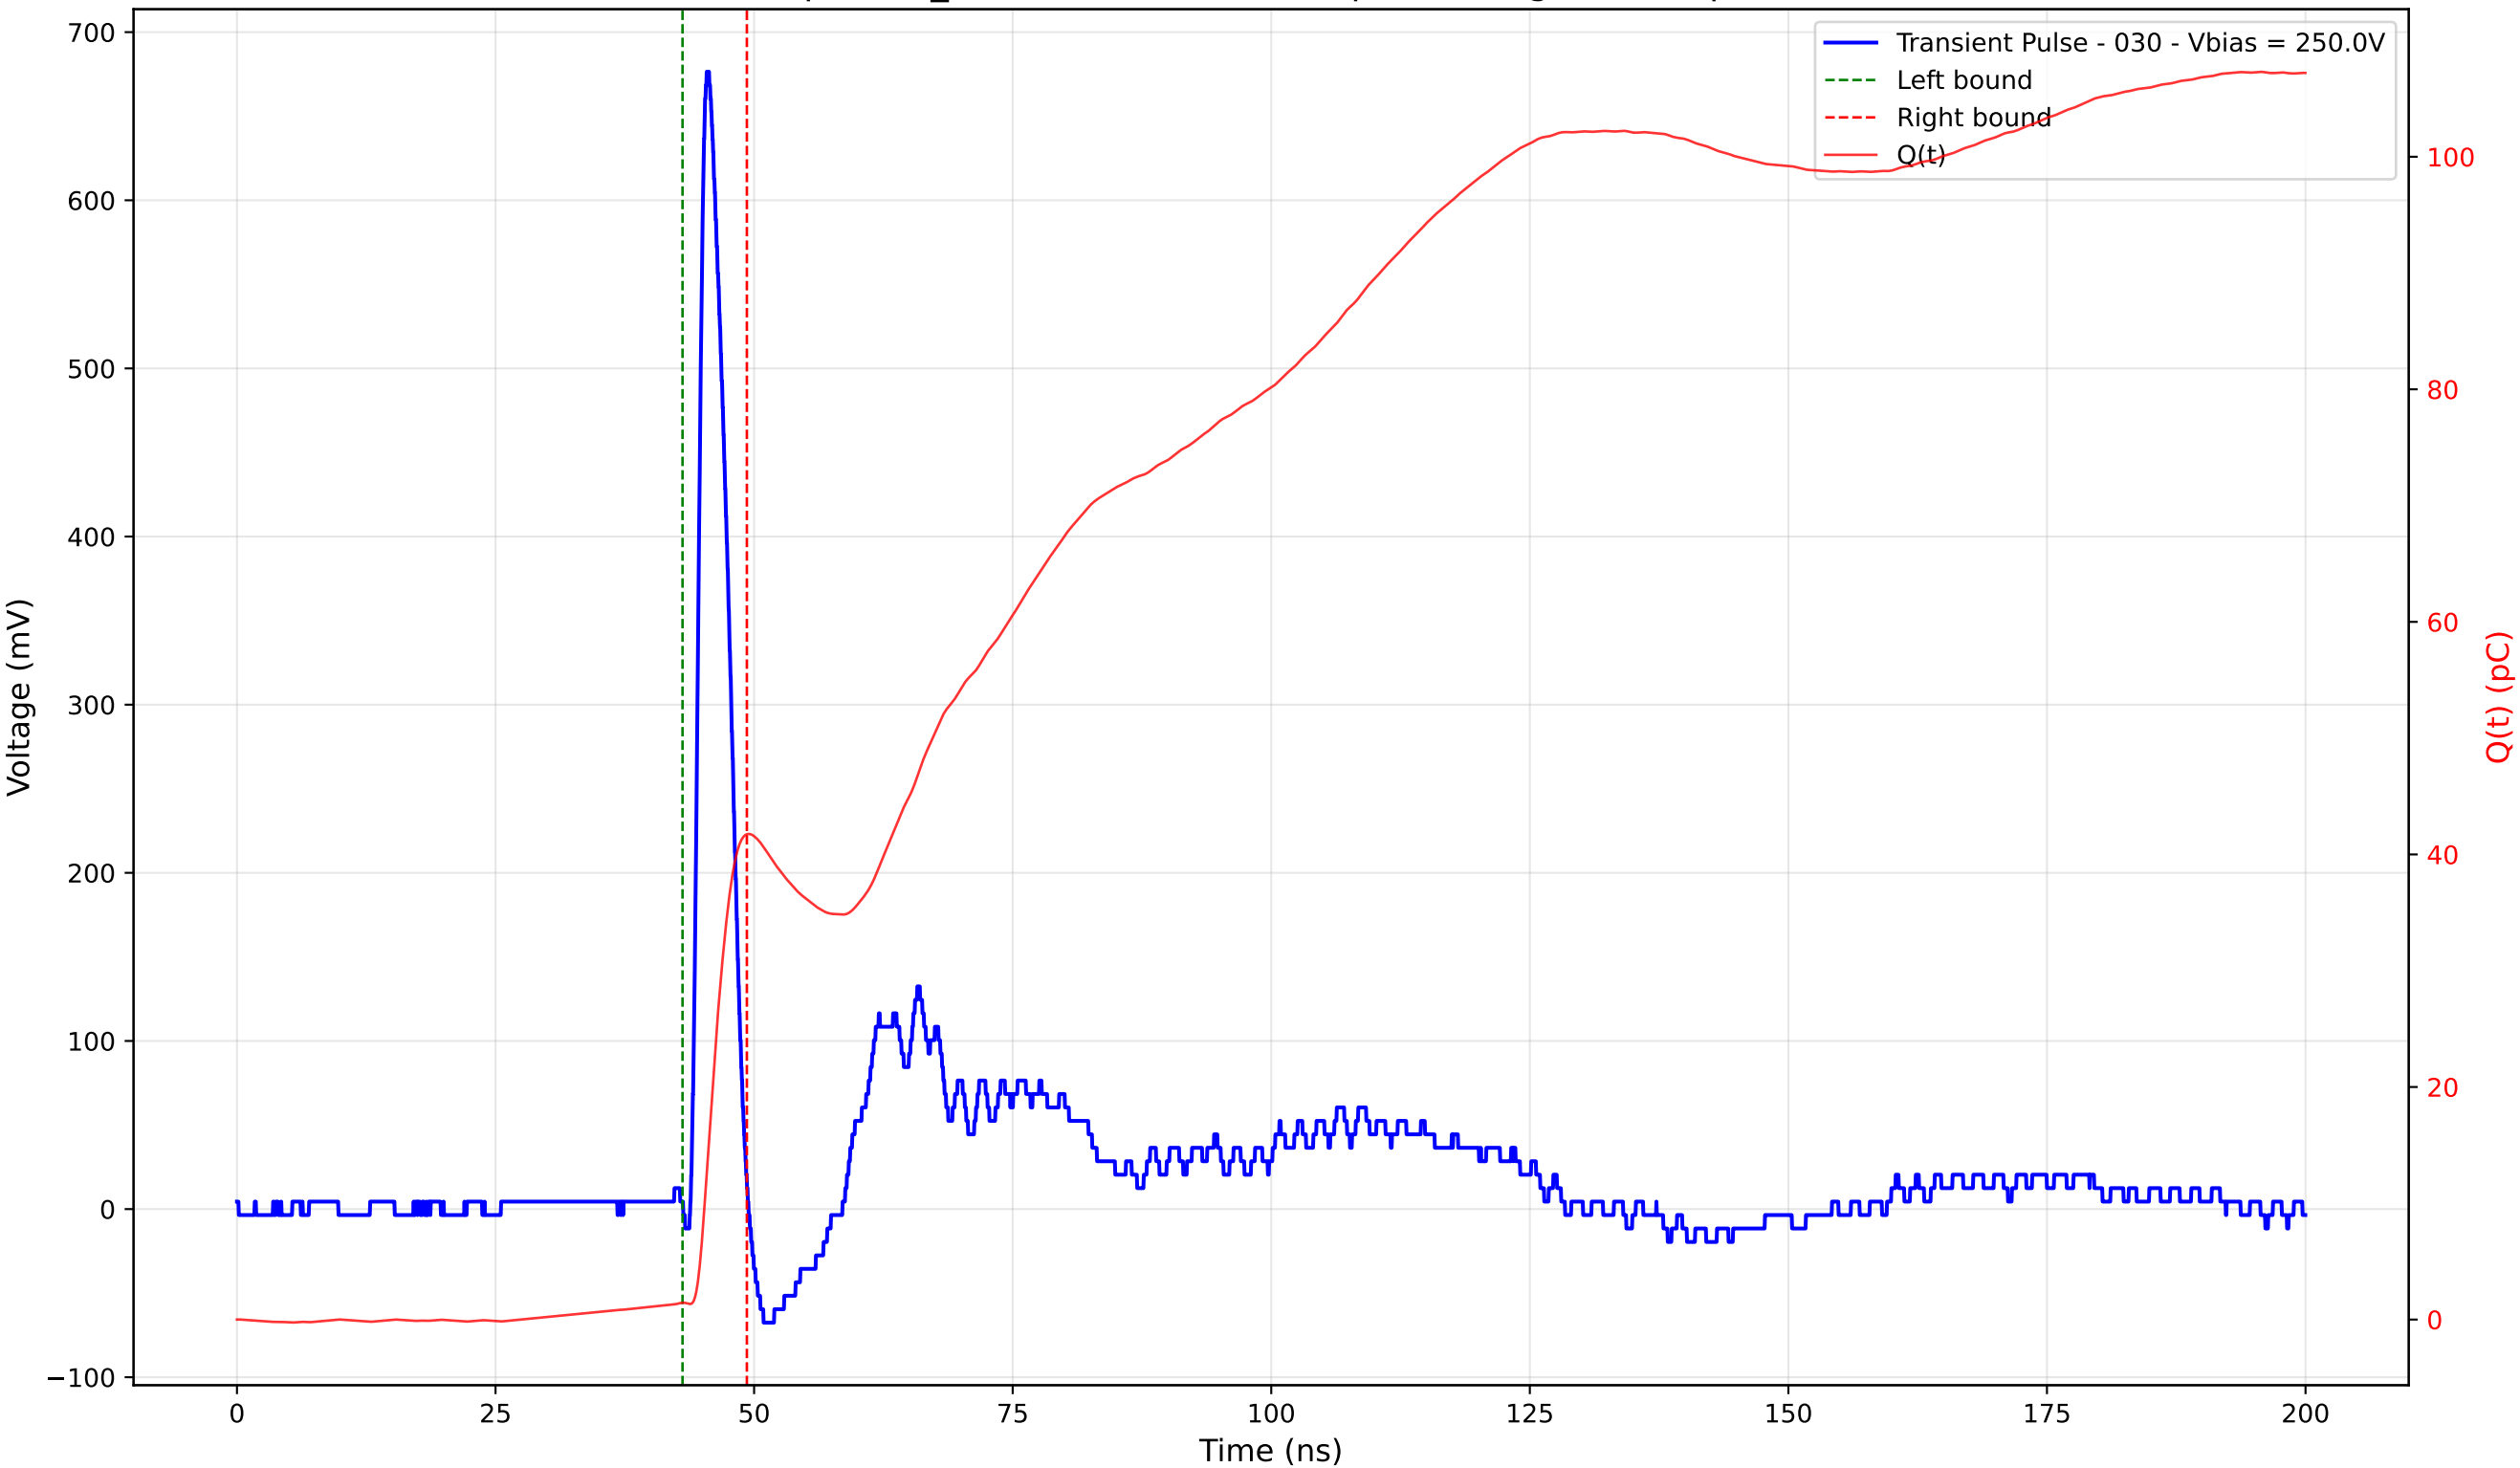


Transient Pulse - Sample: TD_4004 - Position: 325.0 μm - Charge: 39.96 pC - Rise Time: 0.99 ns

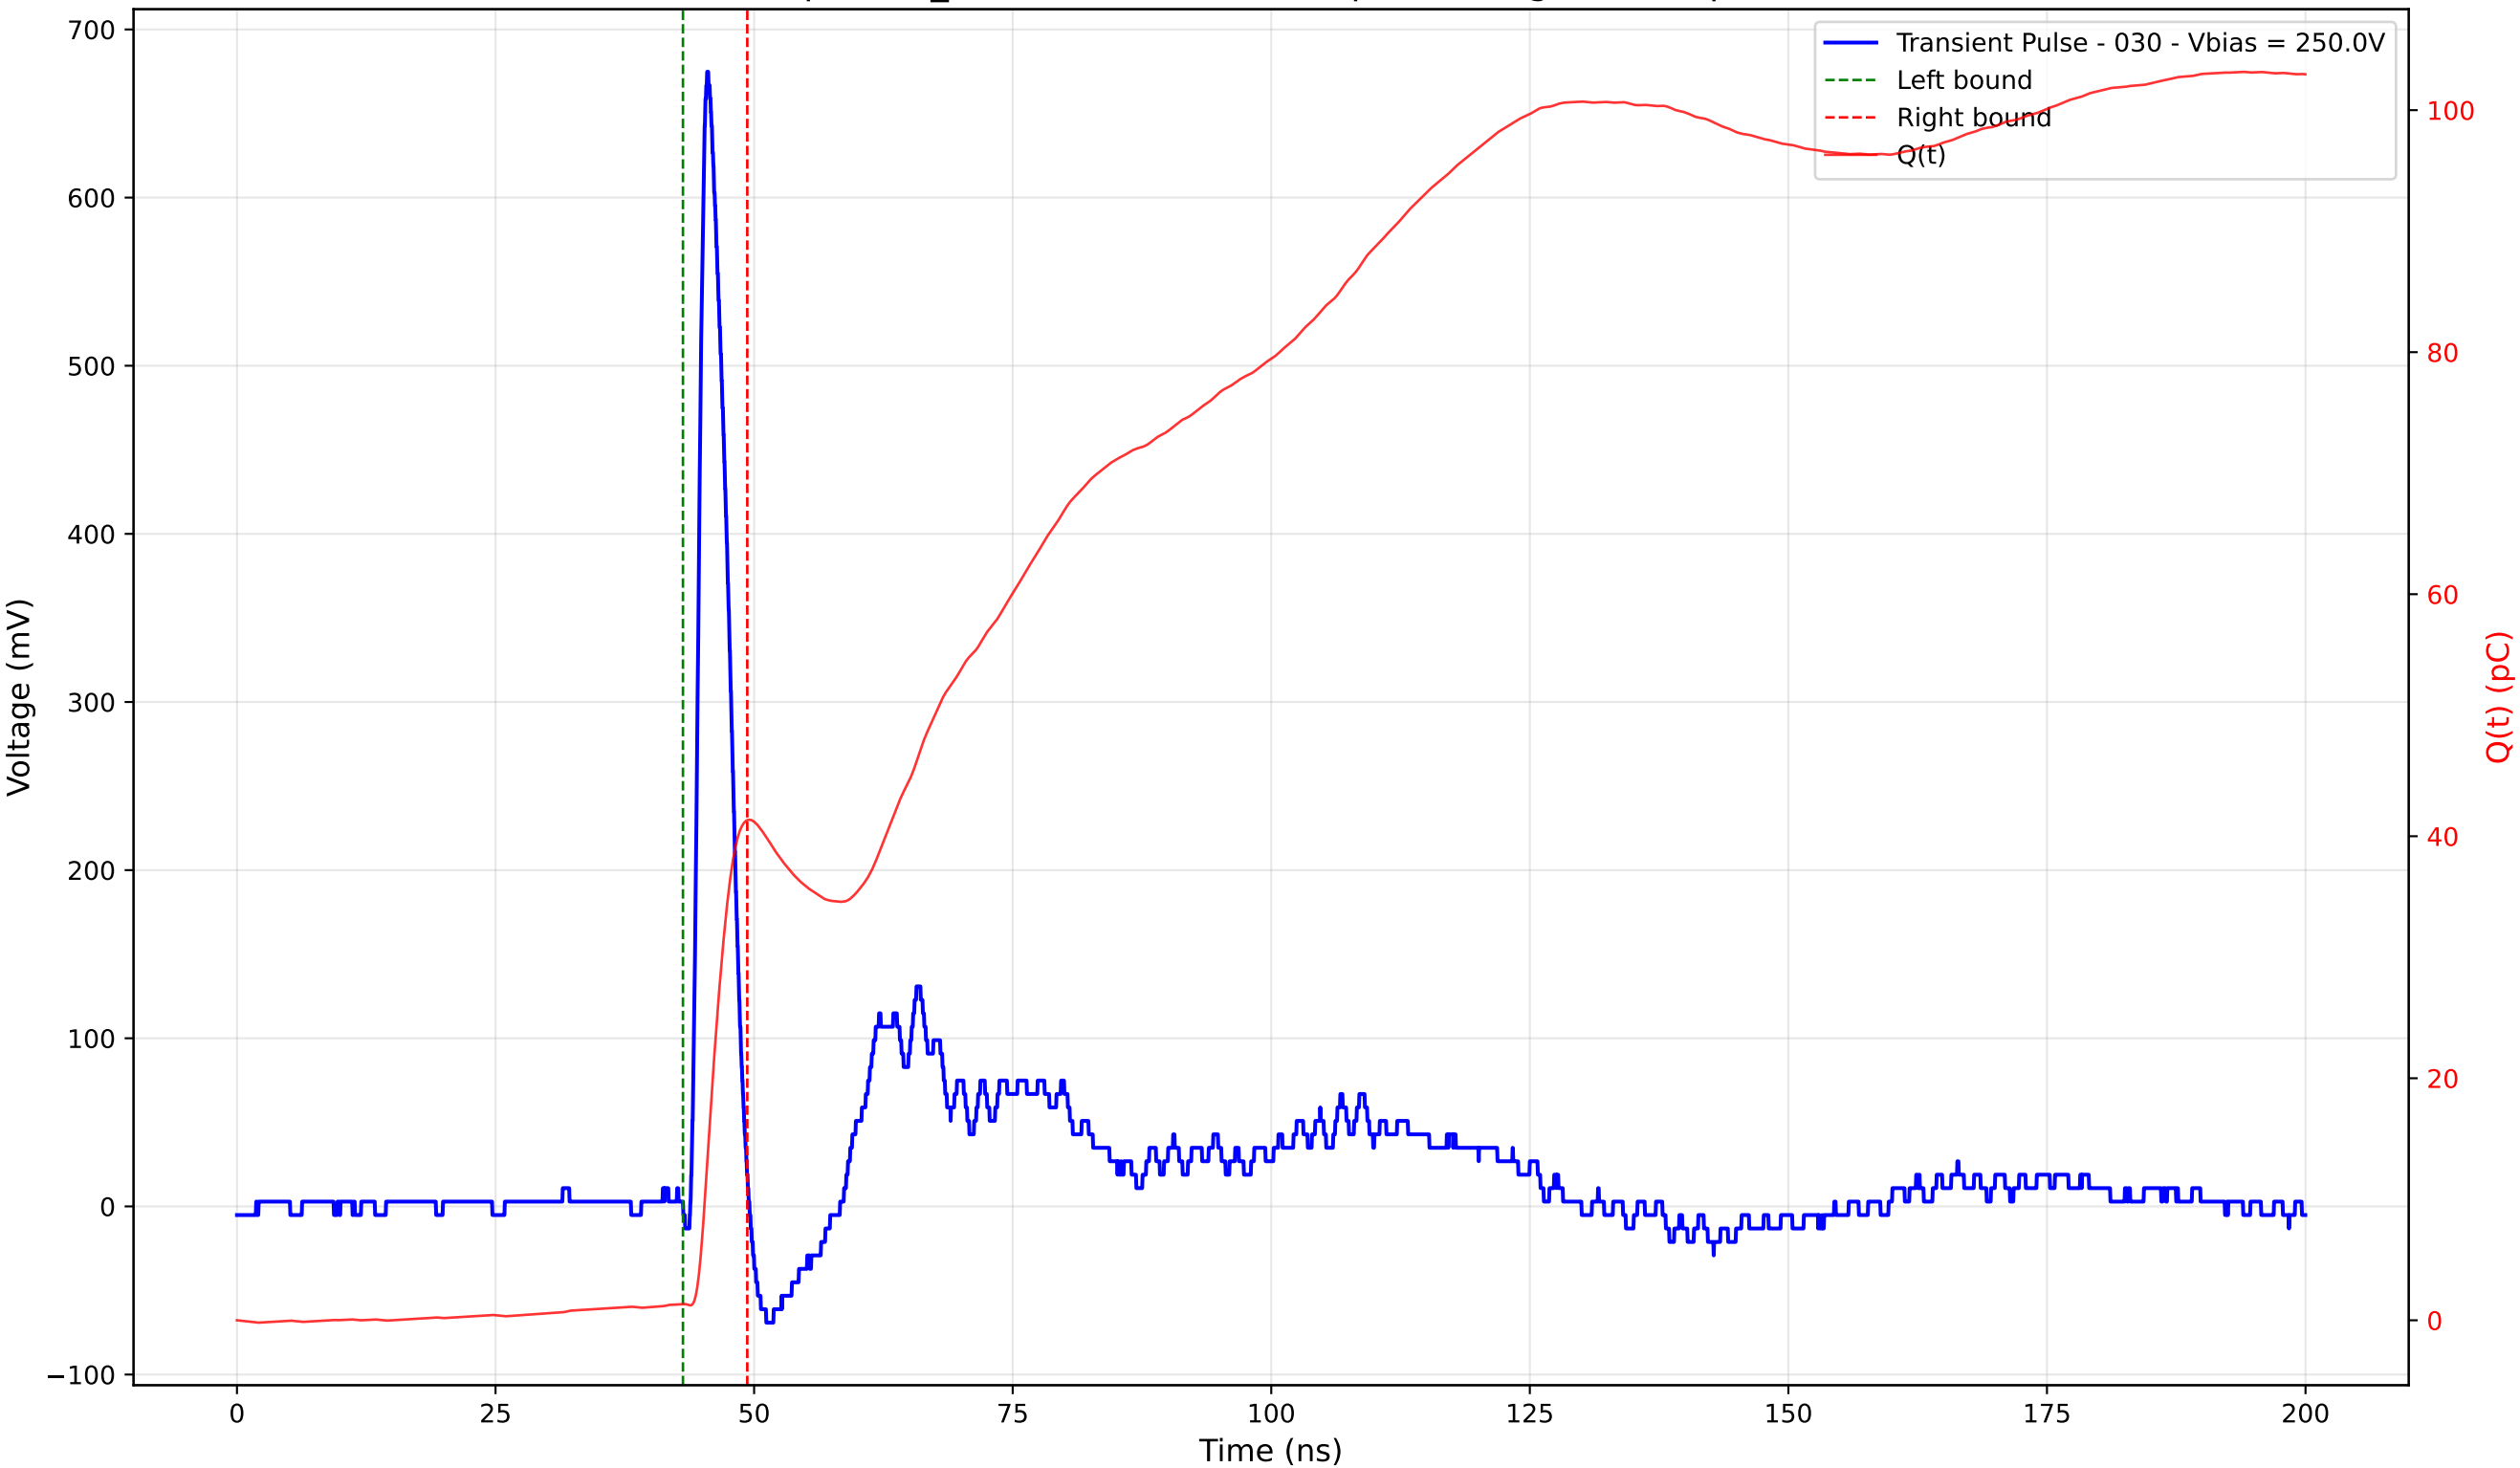


Transient Pulse - Sample: TD_4004 - Position: 330.0 μm - Charge: 37.45 pC - Rise Time: 1.03 ns

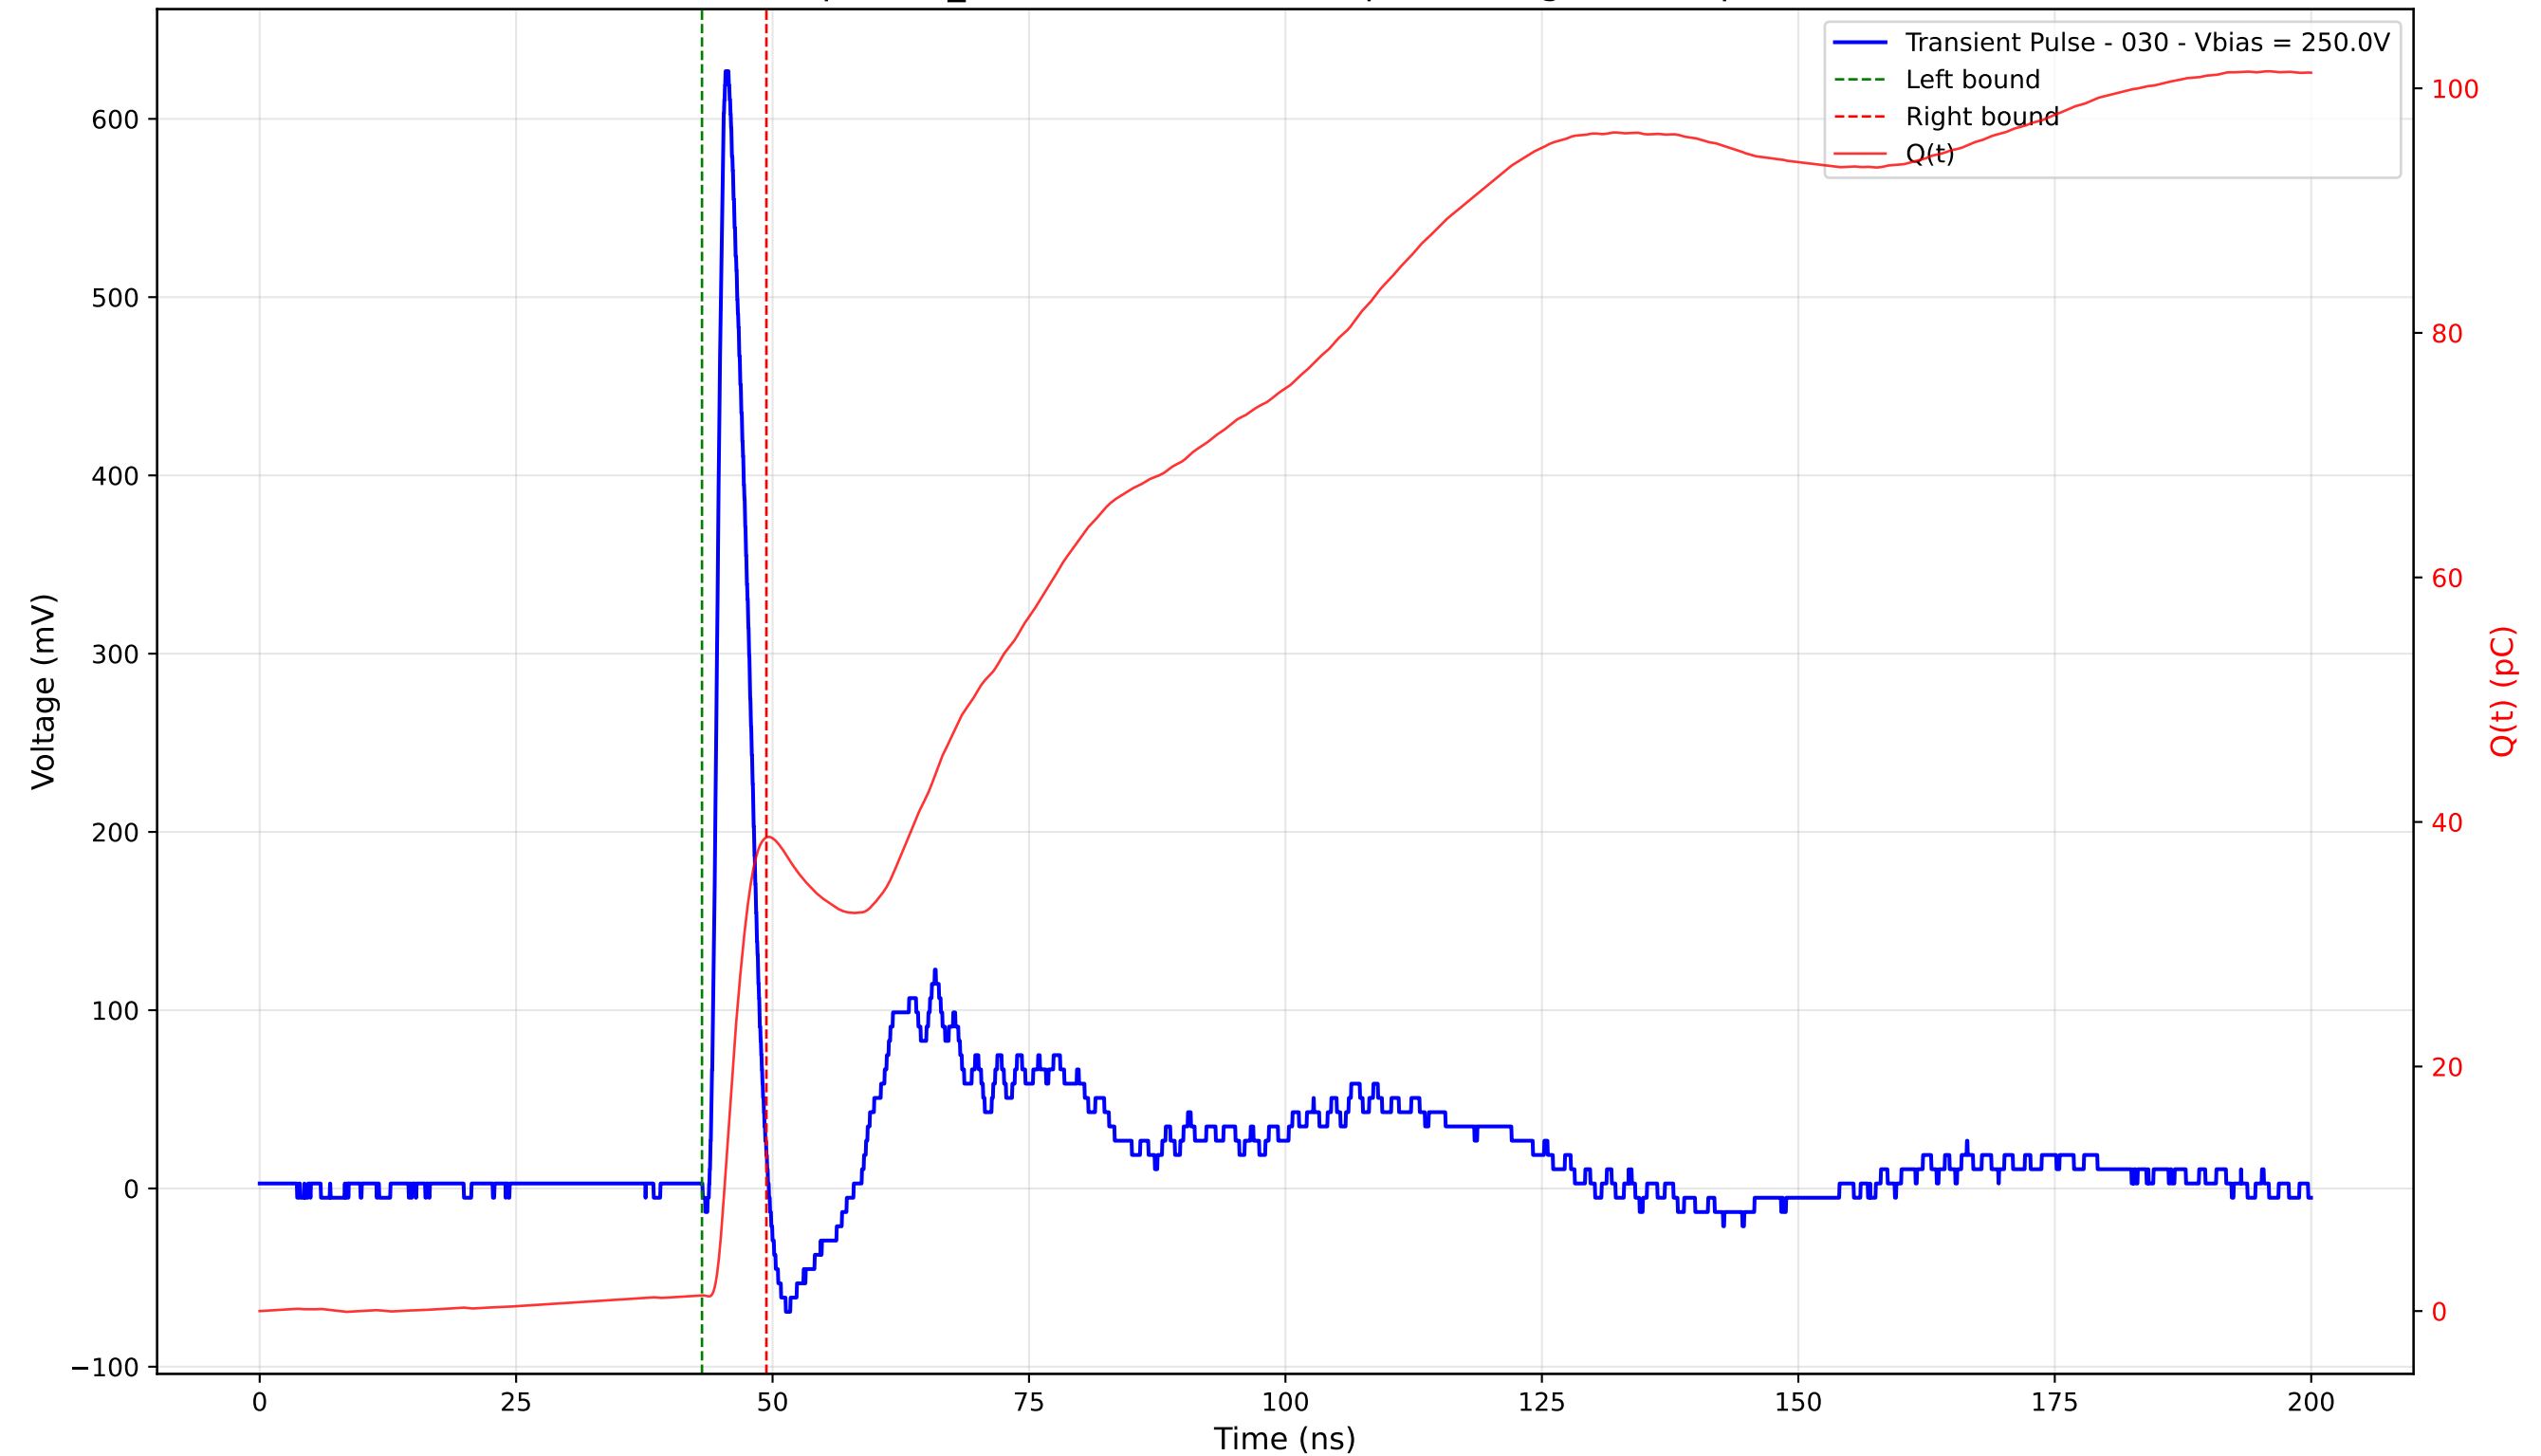


Transient Pulse - Sample: TD_4004 - Position: 335.0 μm - Charge: 35.22 pC - Rise Time: 1.03 ns

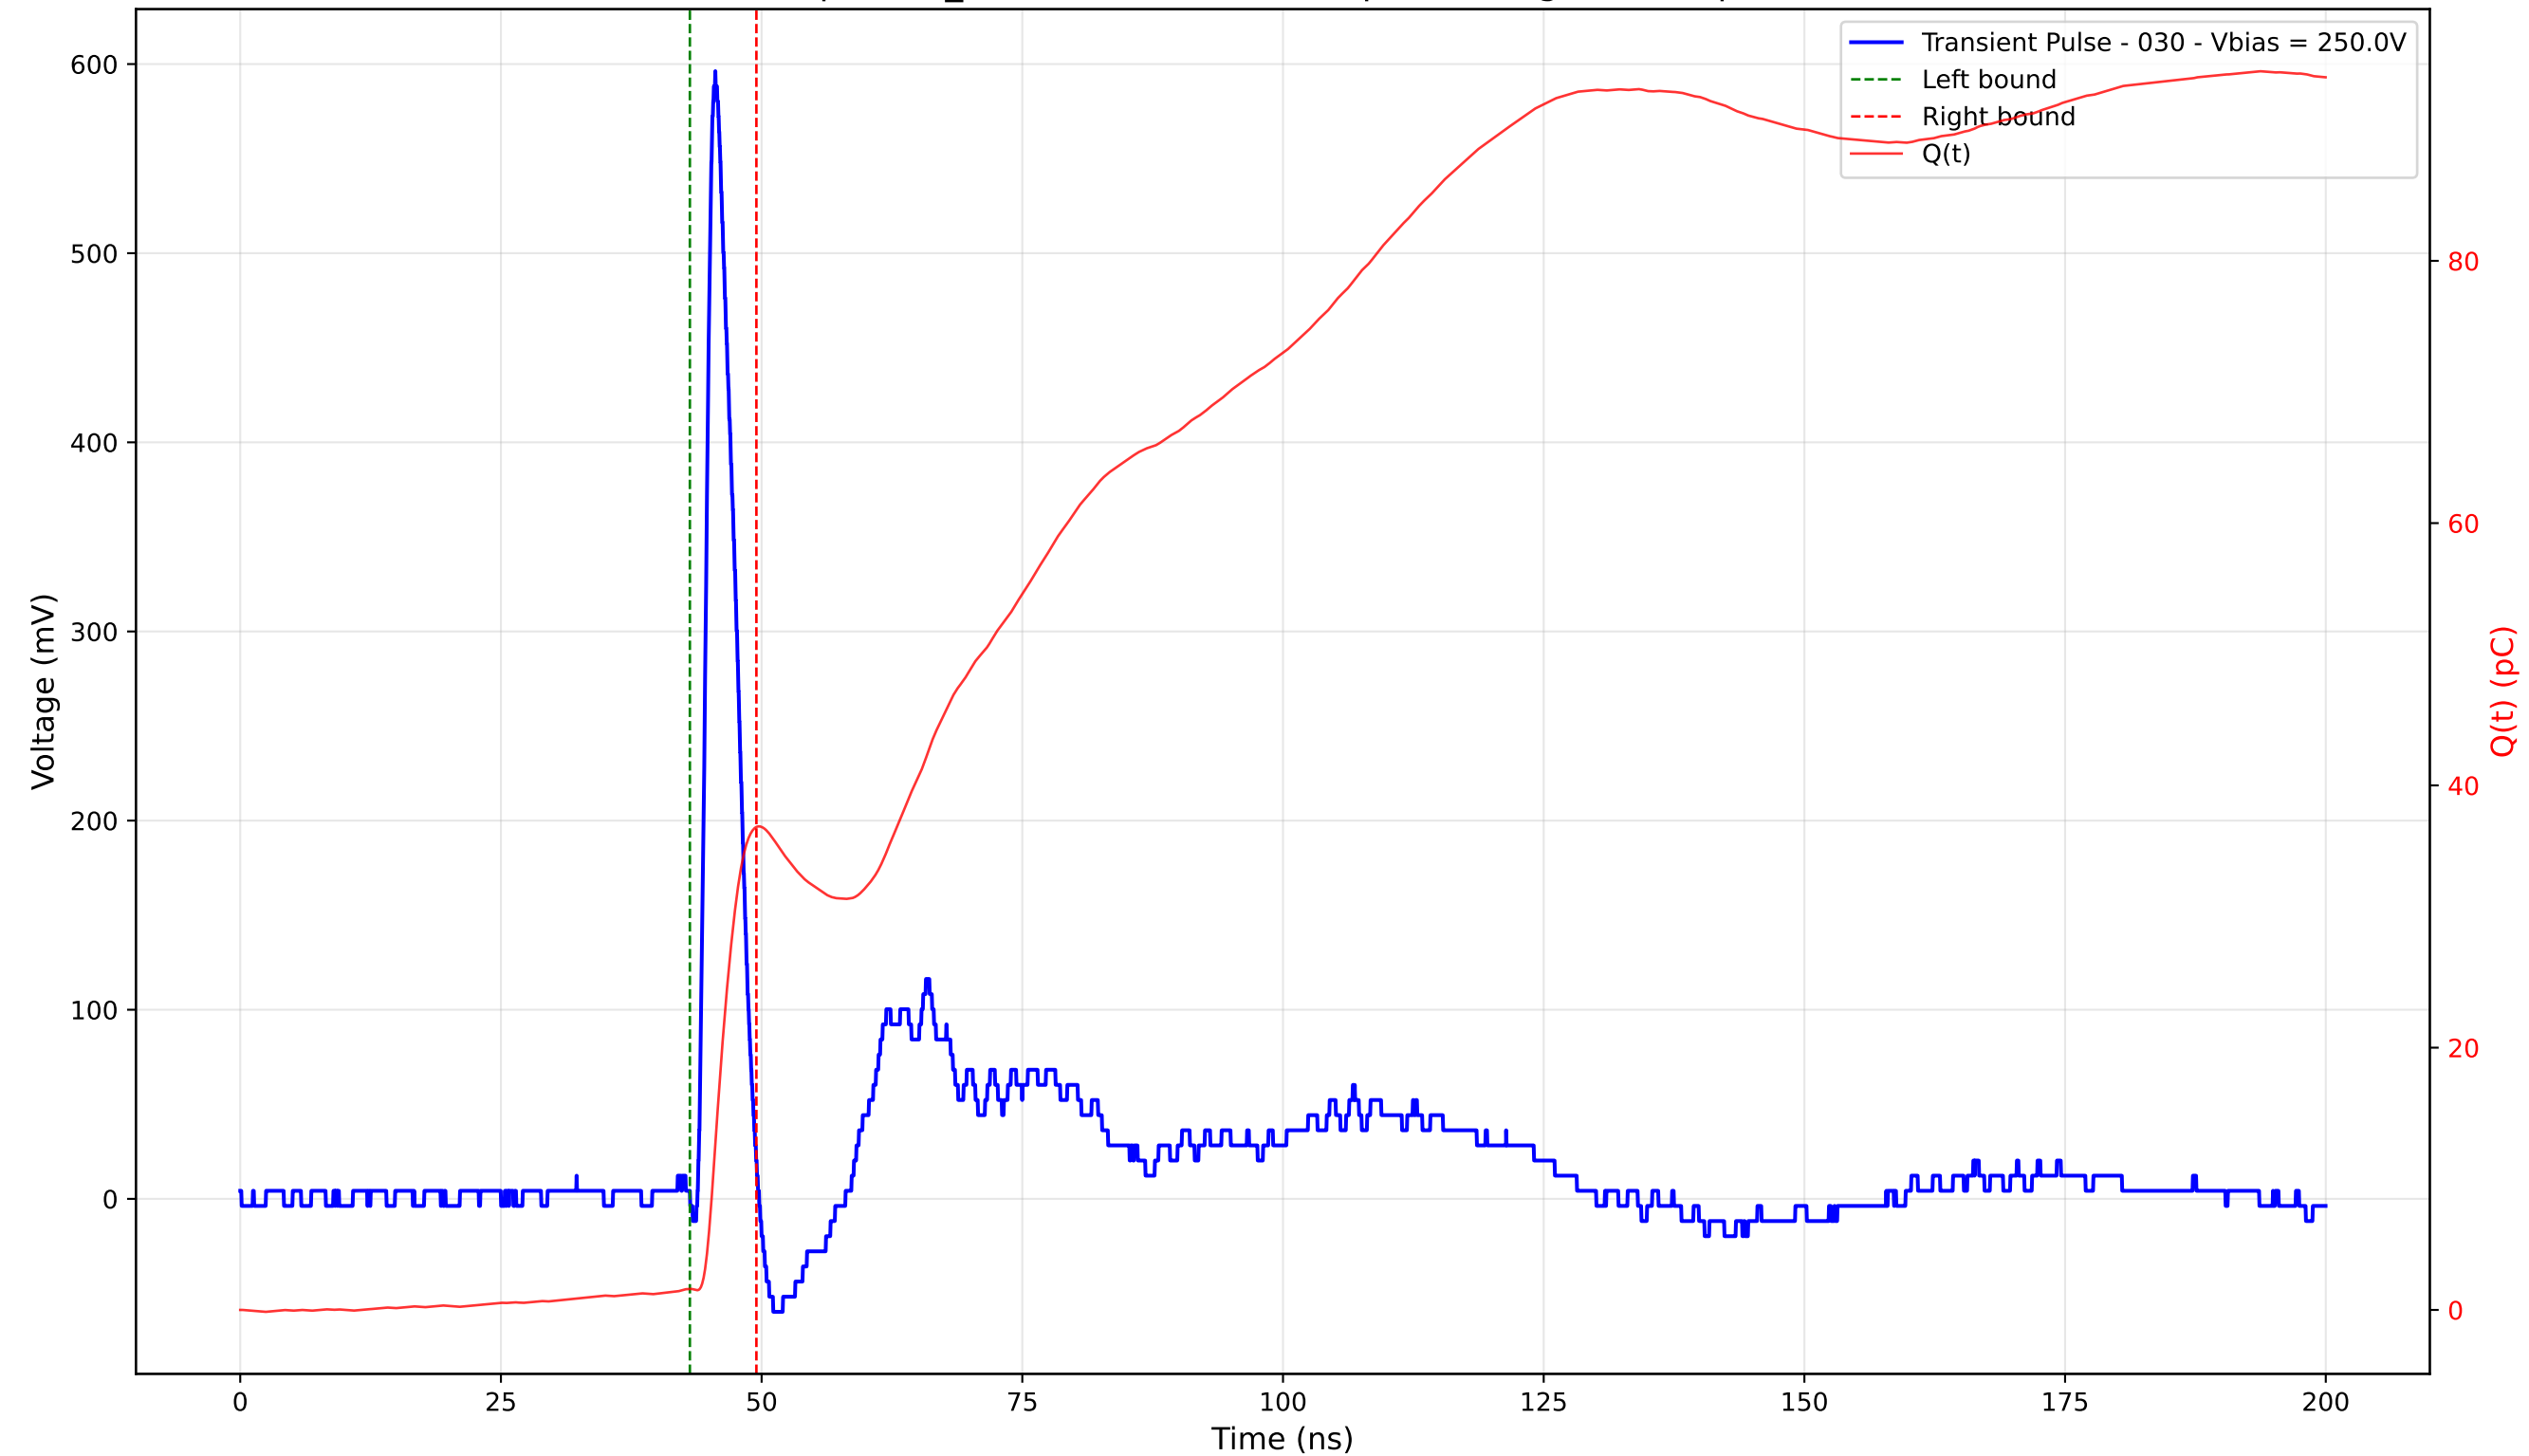


Transient Pulse - Sample: TD_4004 - Position: 340.0 μm - Charge: 34.58 pC - Rise Time: 1.02 ns

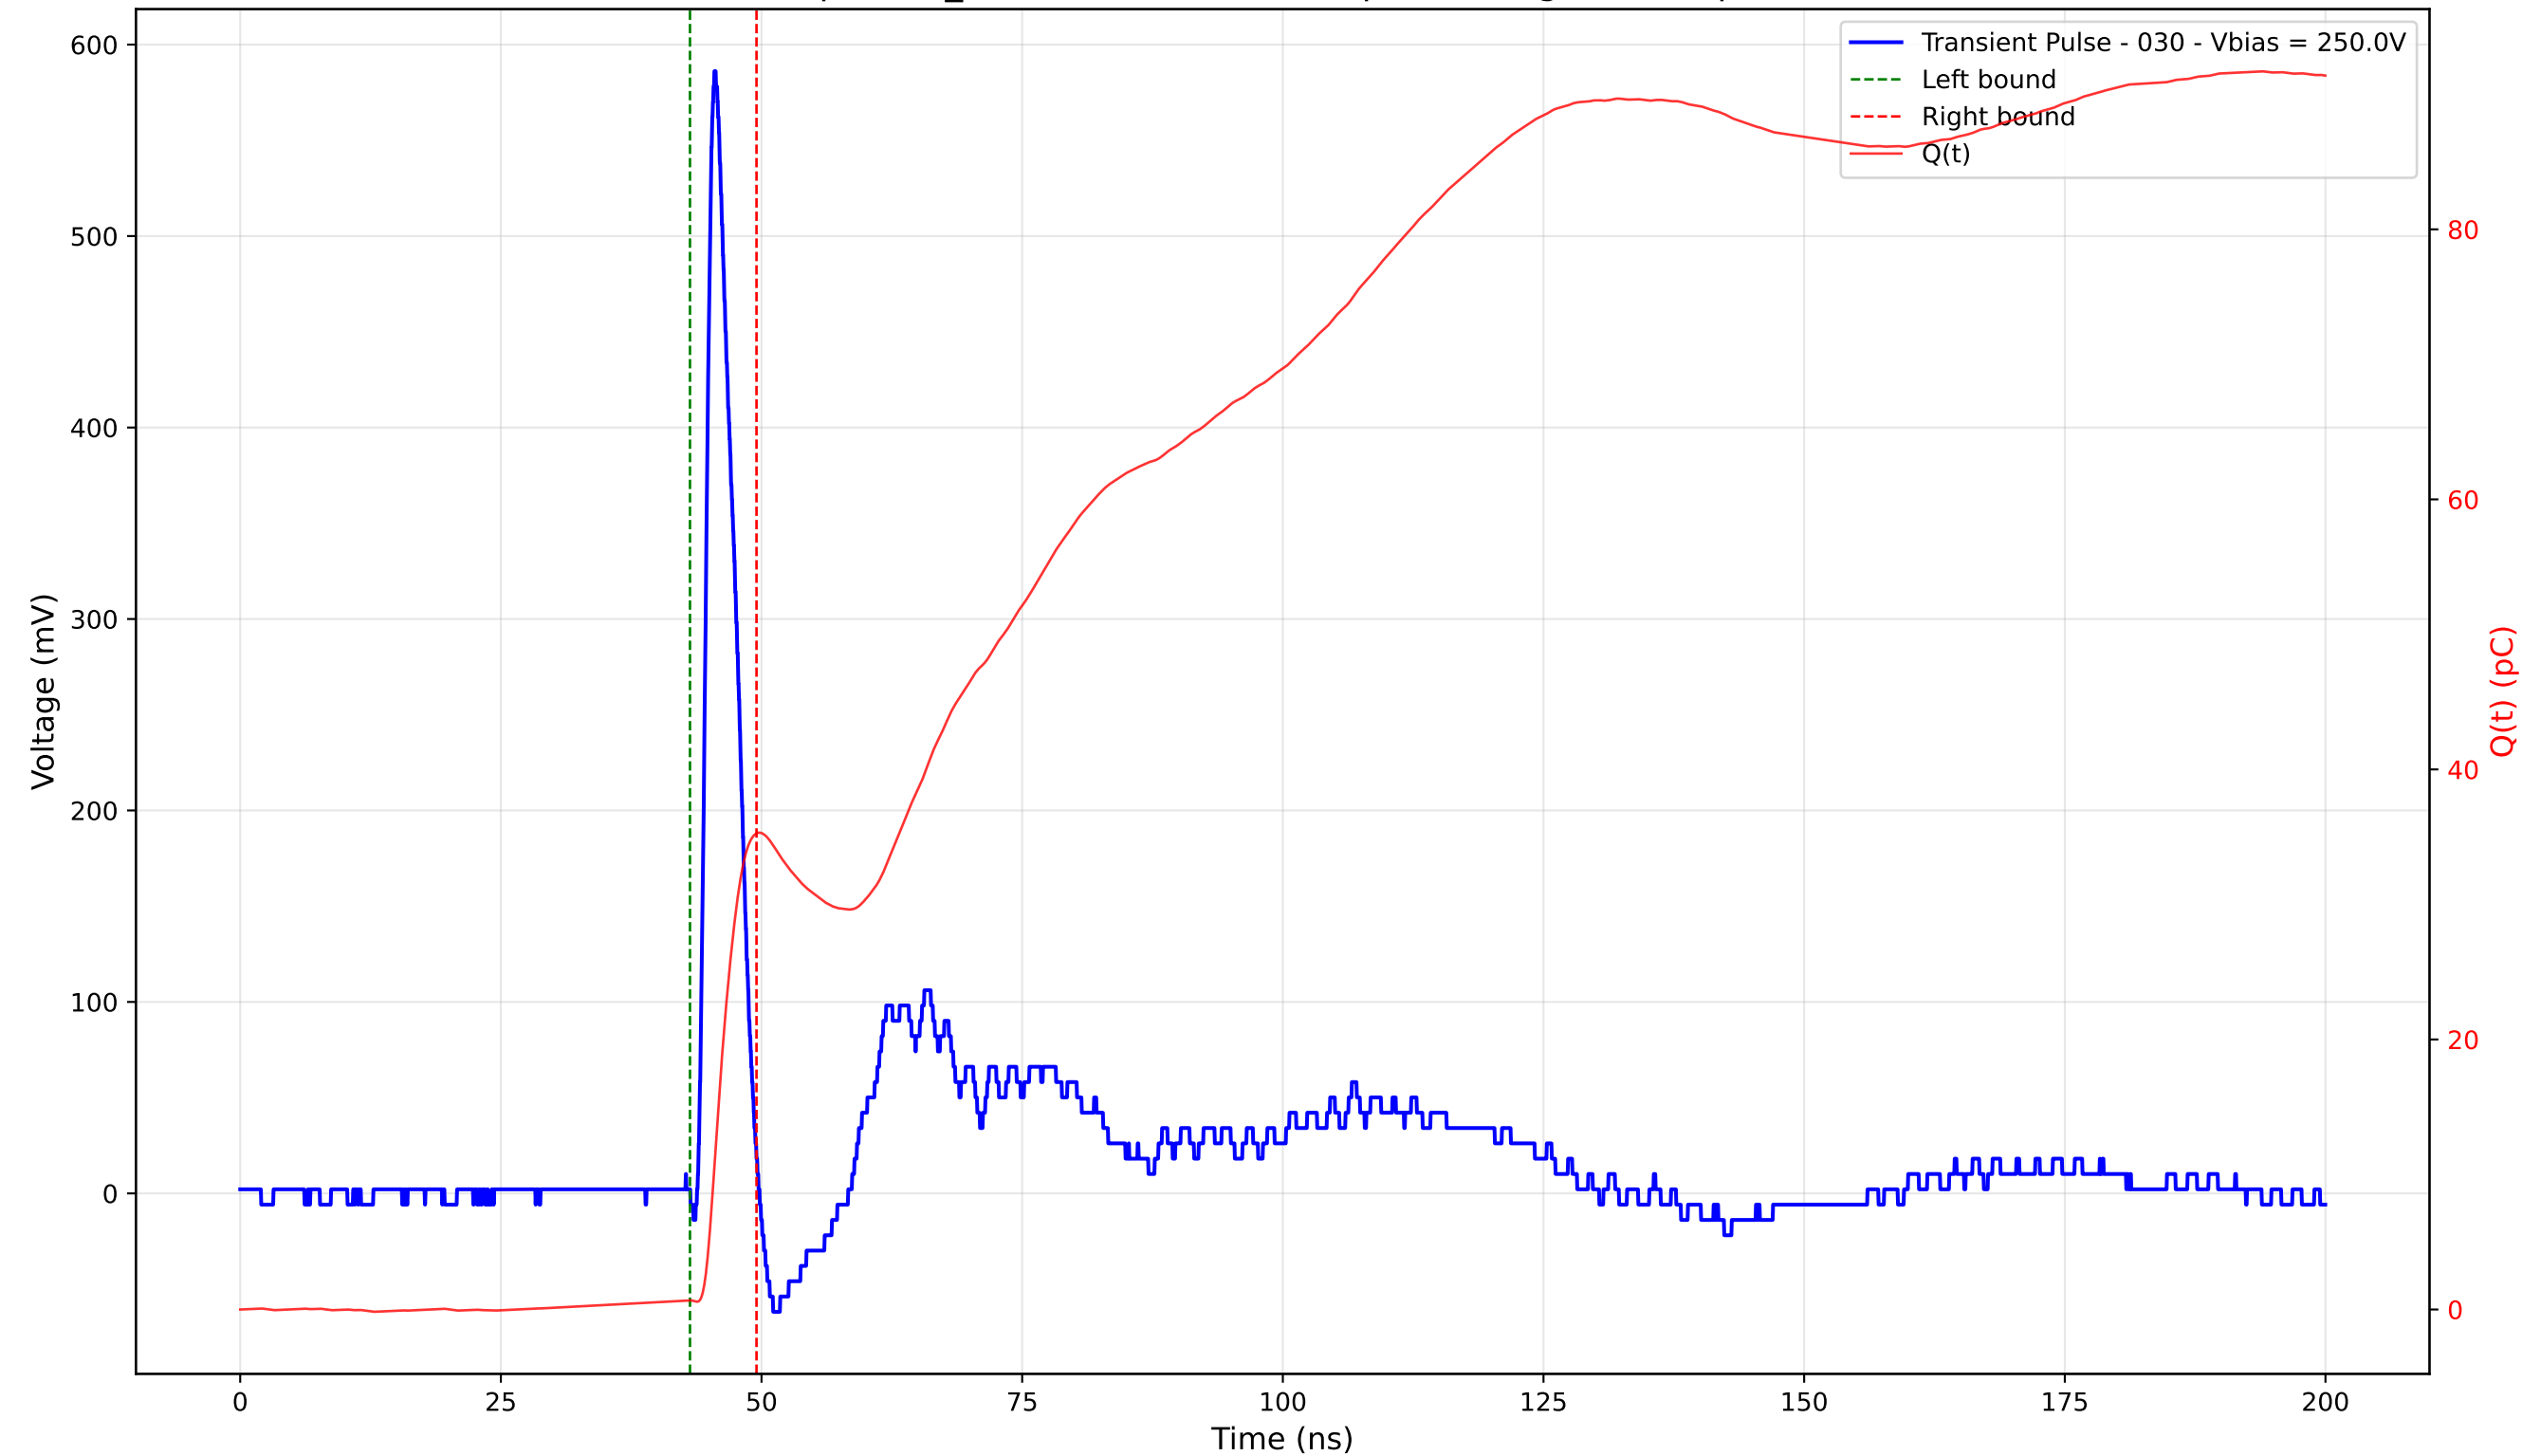


Transient Pulse - Sample: TD_4004 - Position: 345.0 μm - Charge: 34.50 pC - Rise Time: 0.99 ns

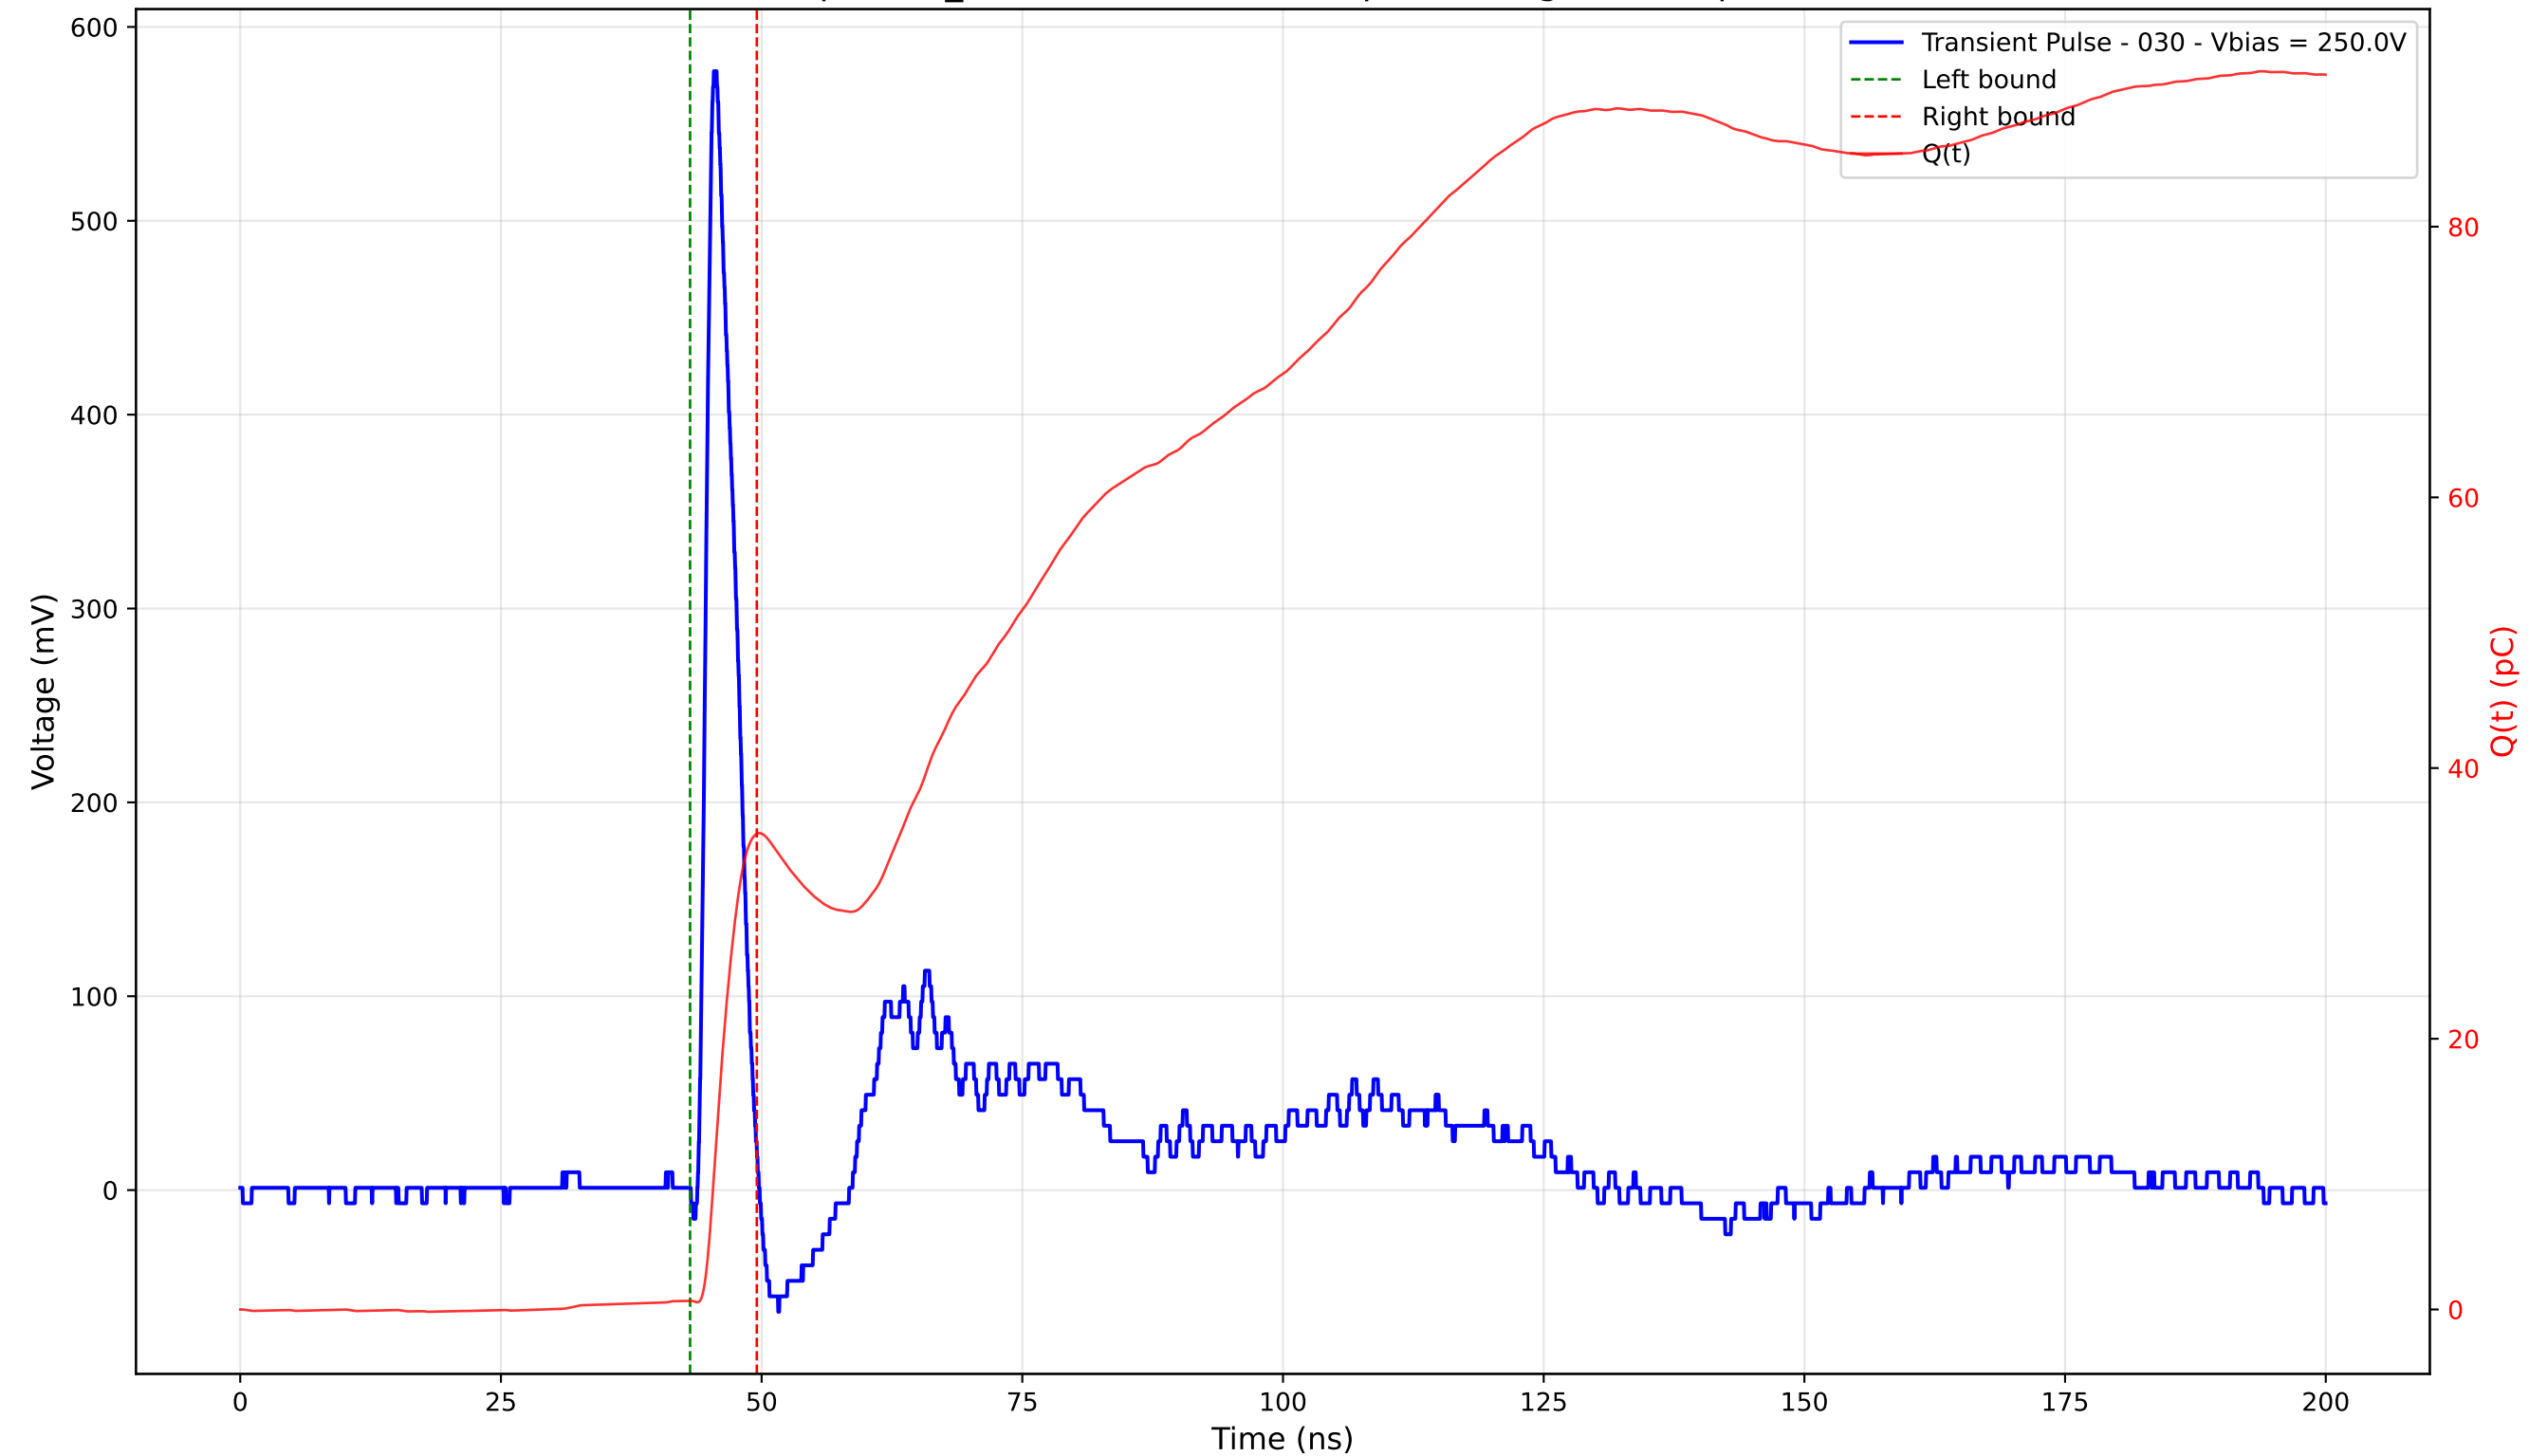


Transient Pulse - Sample: TD_4004 - Position: 350.0 μm - Charge: 34.14 pC - Rise Time: 1.00 ns

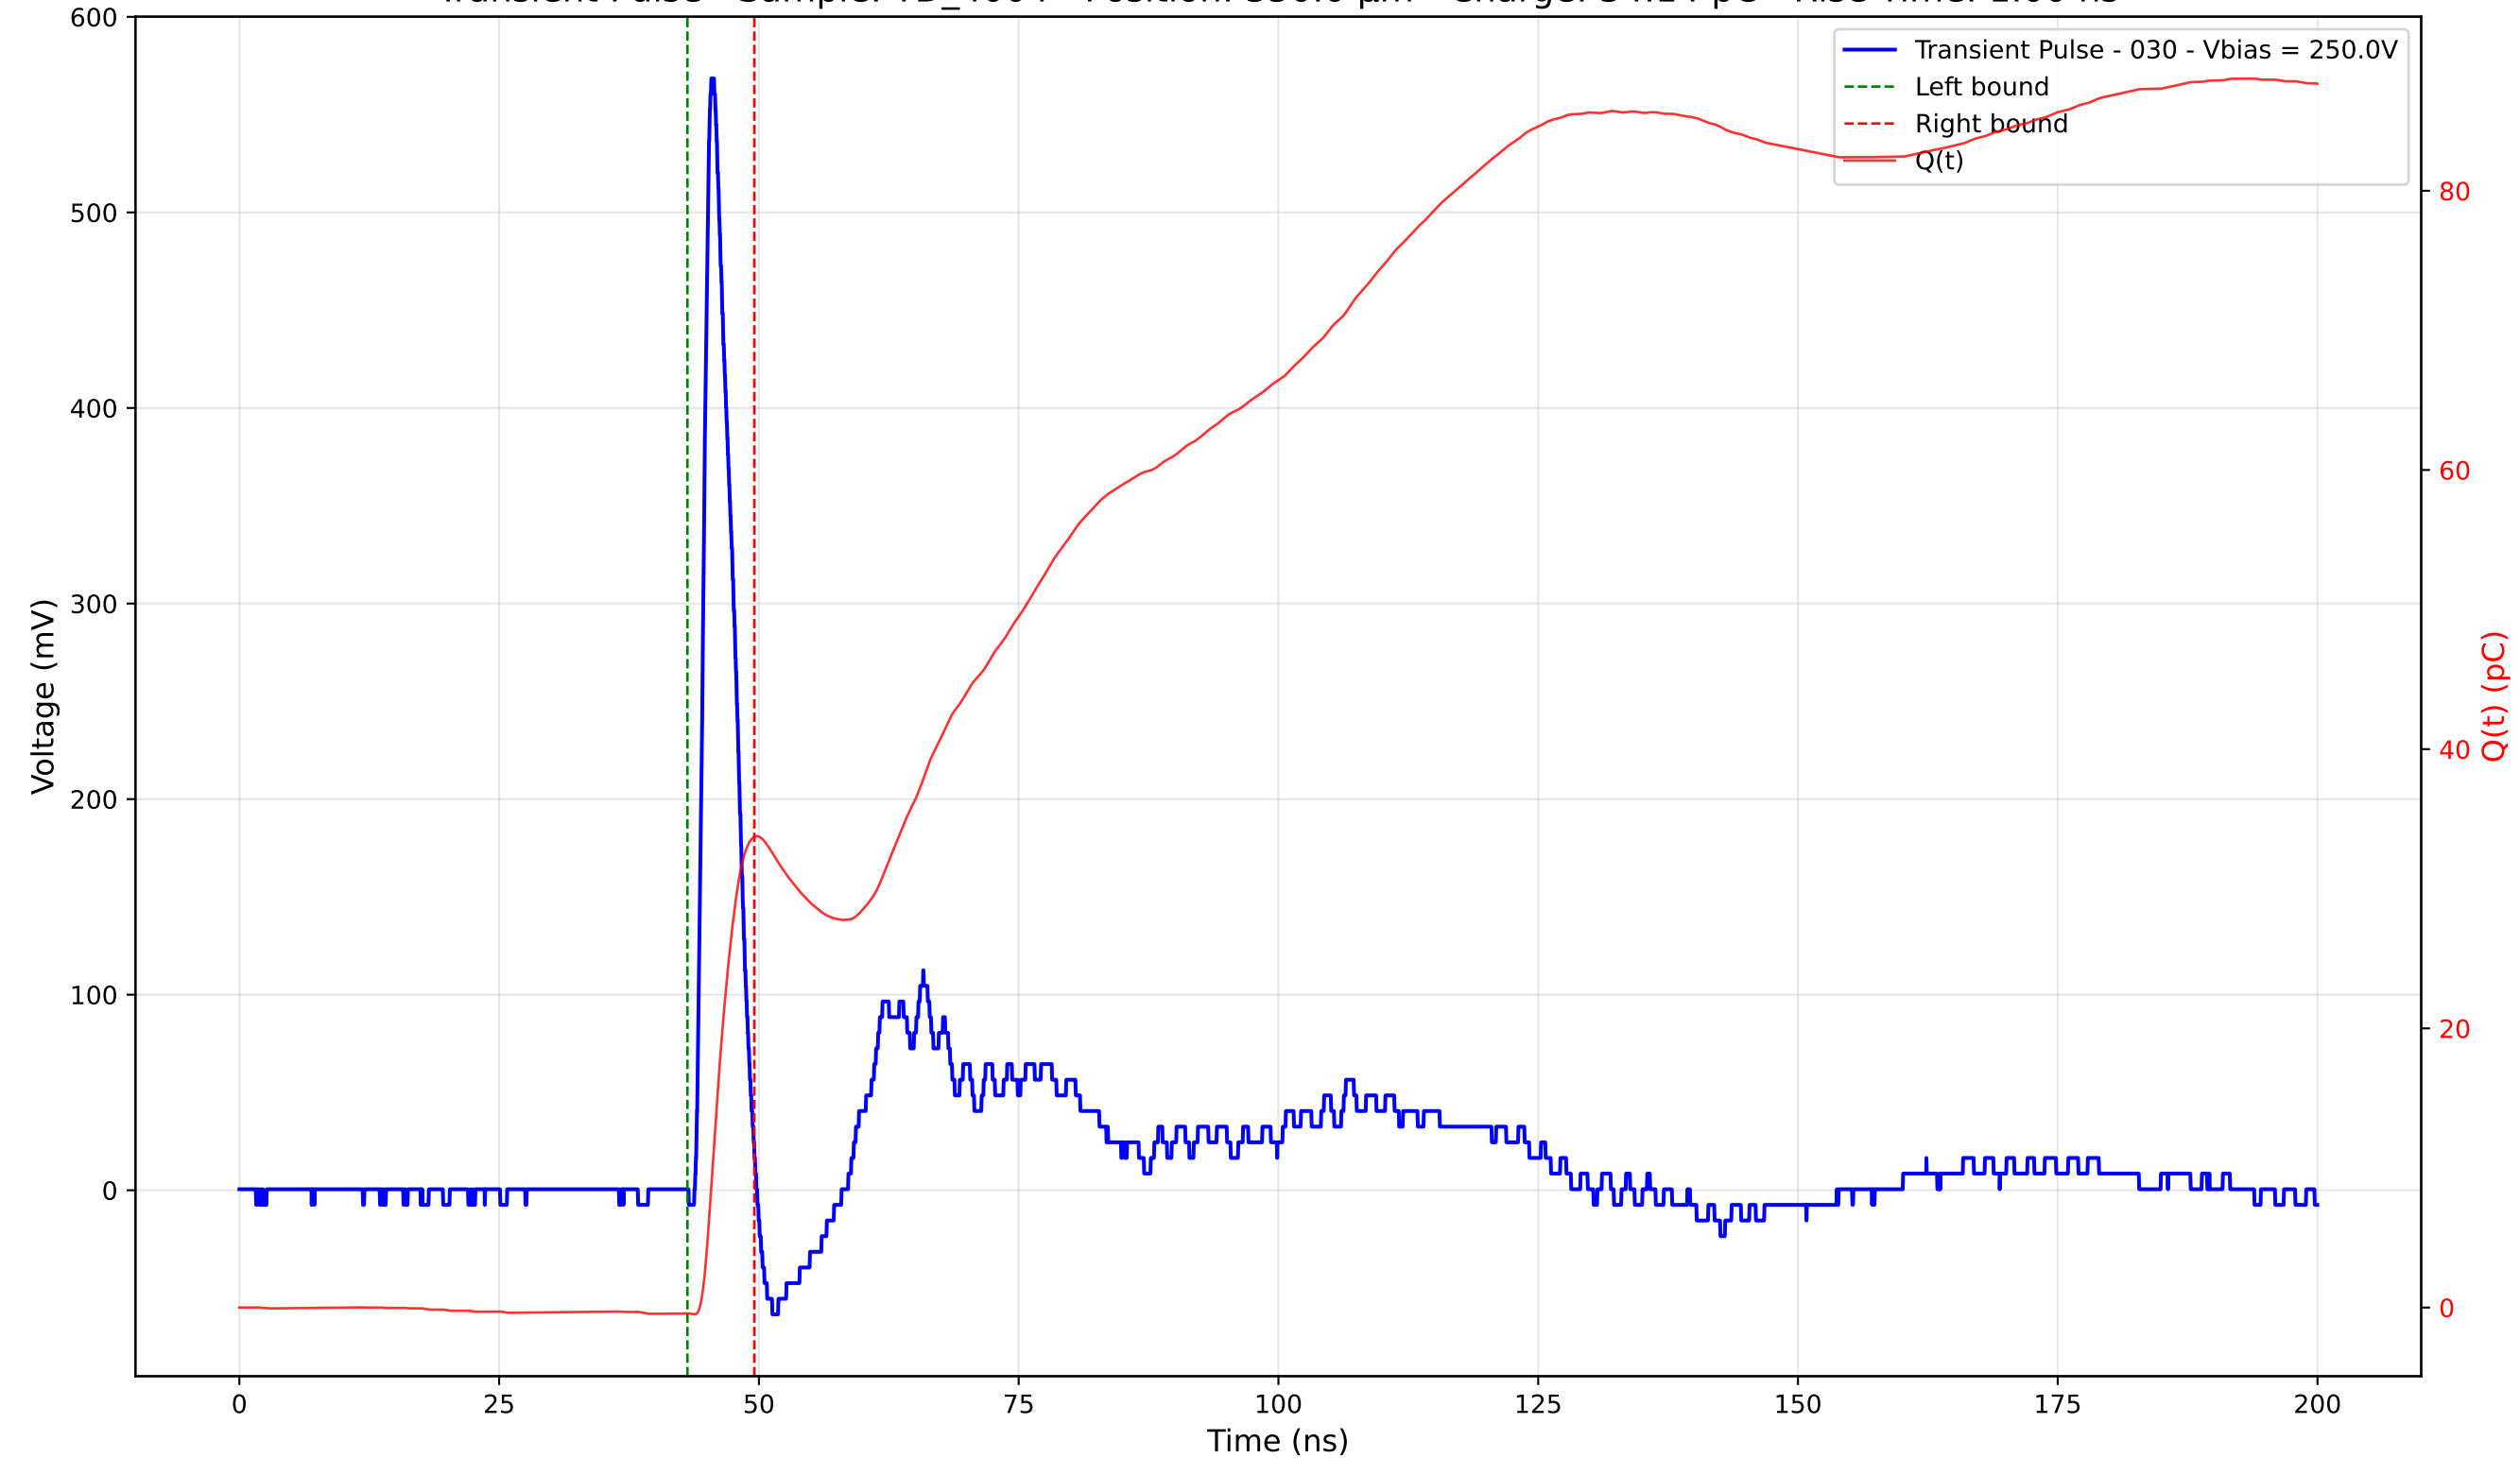


Transient Pulse - Sample: TD_4004 - Position: 355.0 μm - Charge: 34.57 pC - Rise Time: 1.04 ns

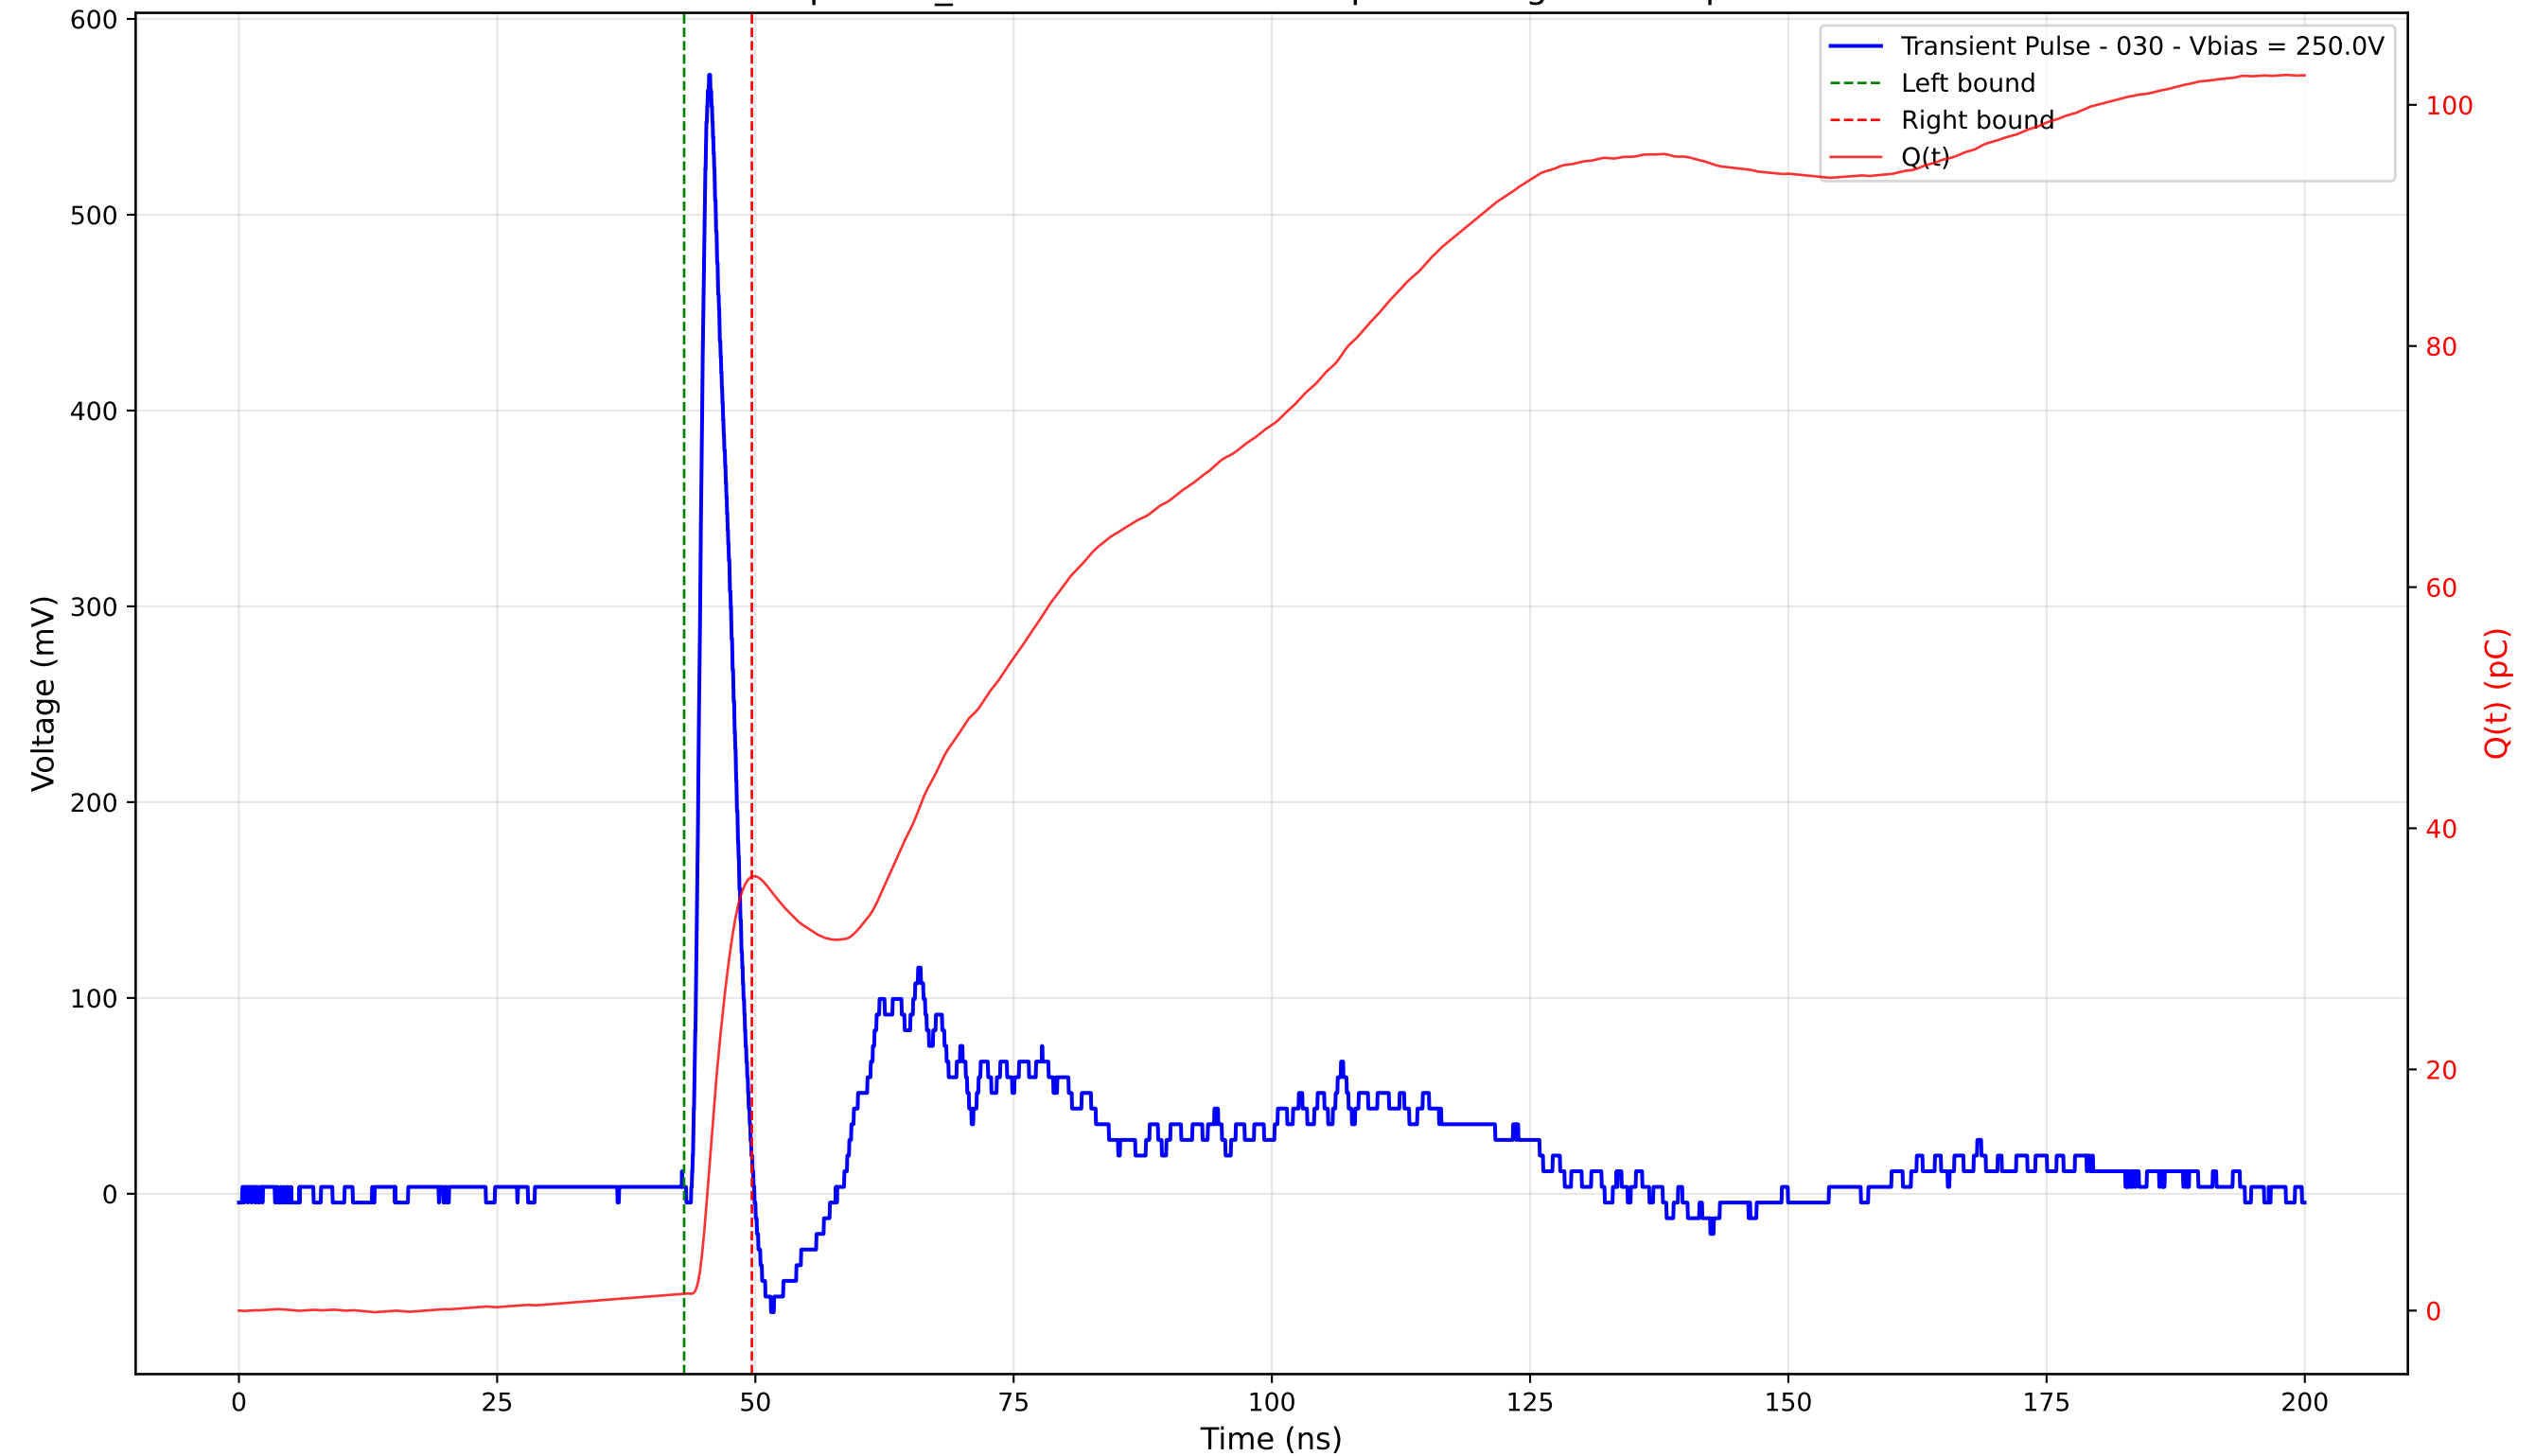


Transient Pulse - Sample: TD_4004 - Position: 360.0 μm - Charge: 33.86 pC - Rise Time: 1.03 ns

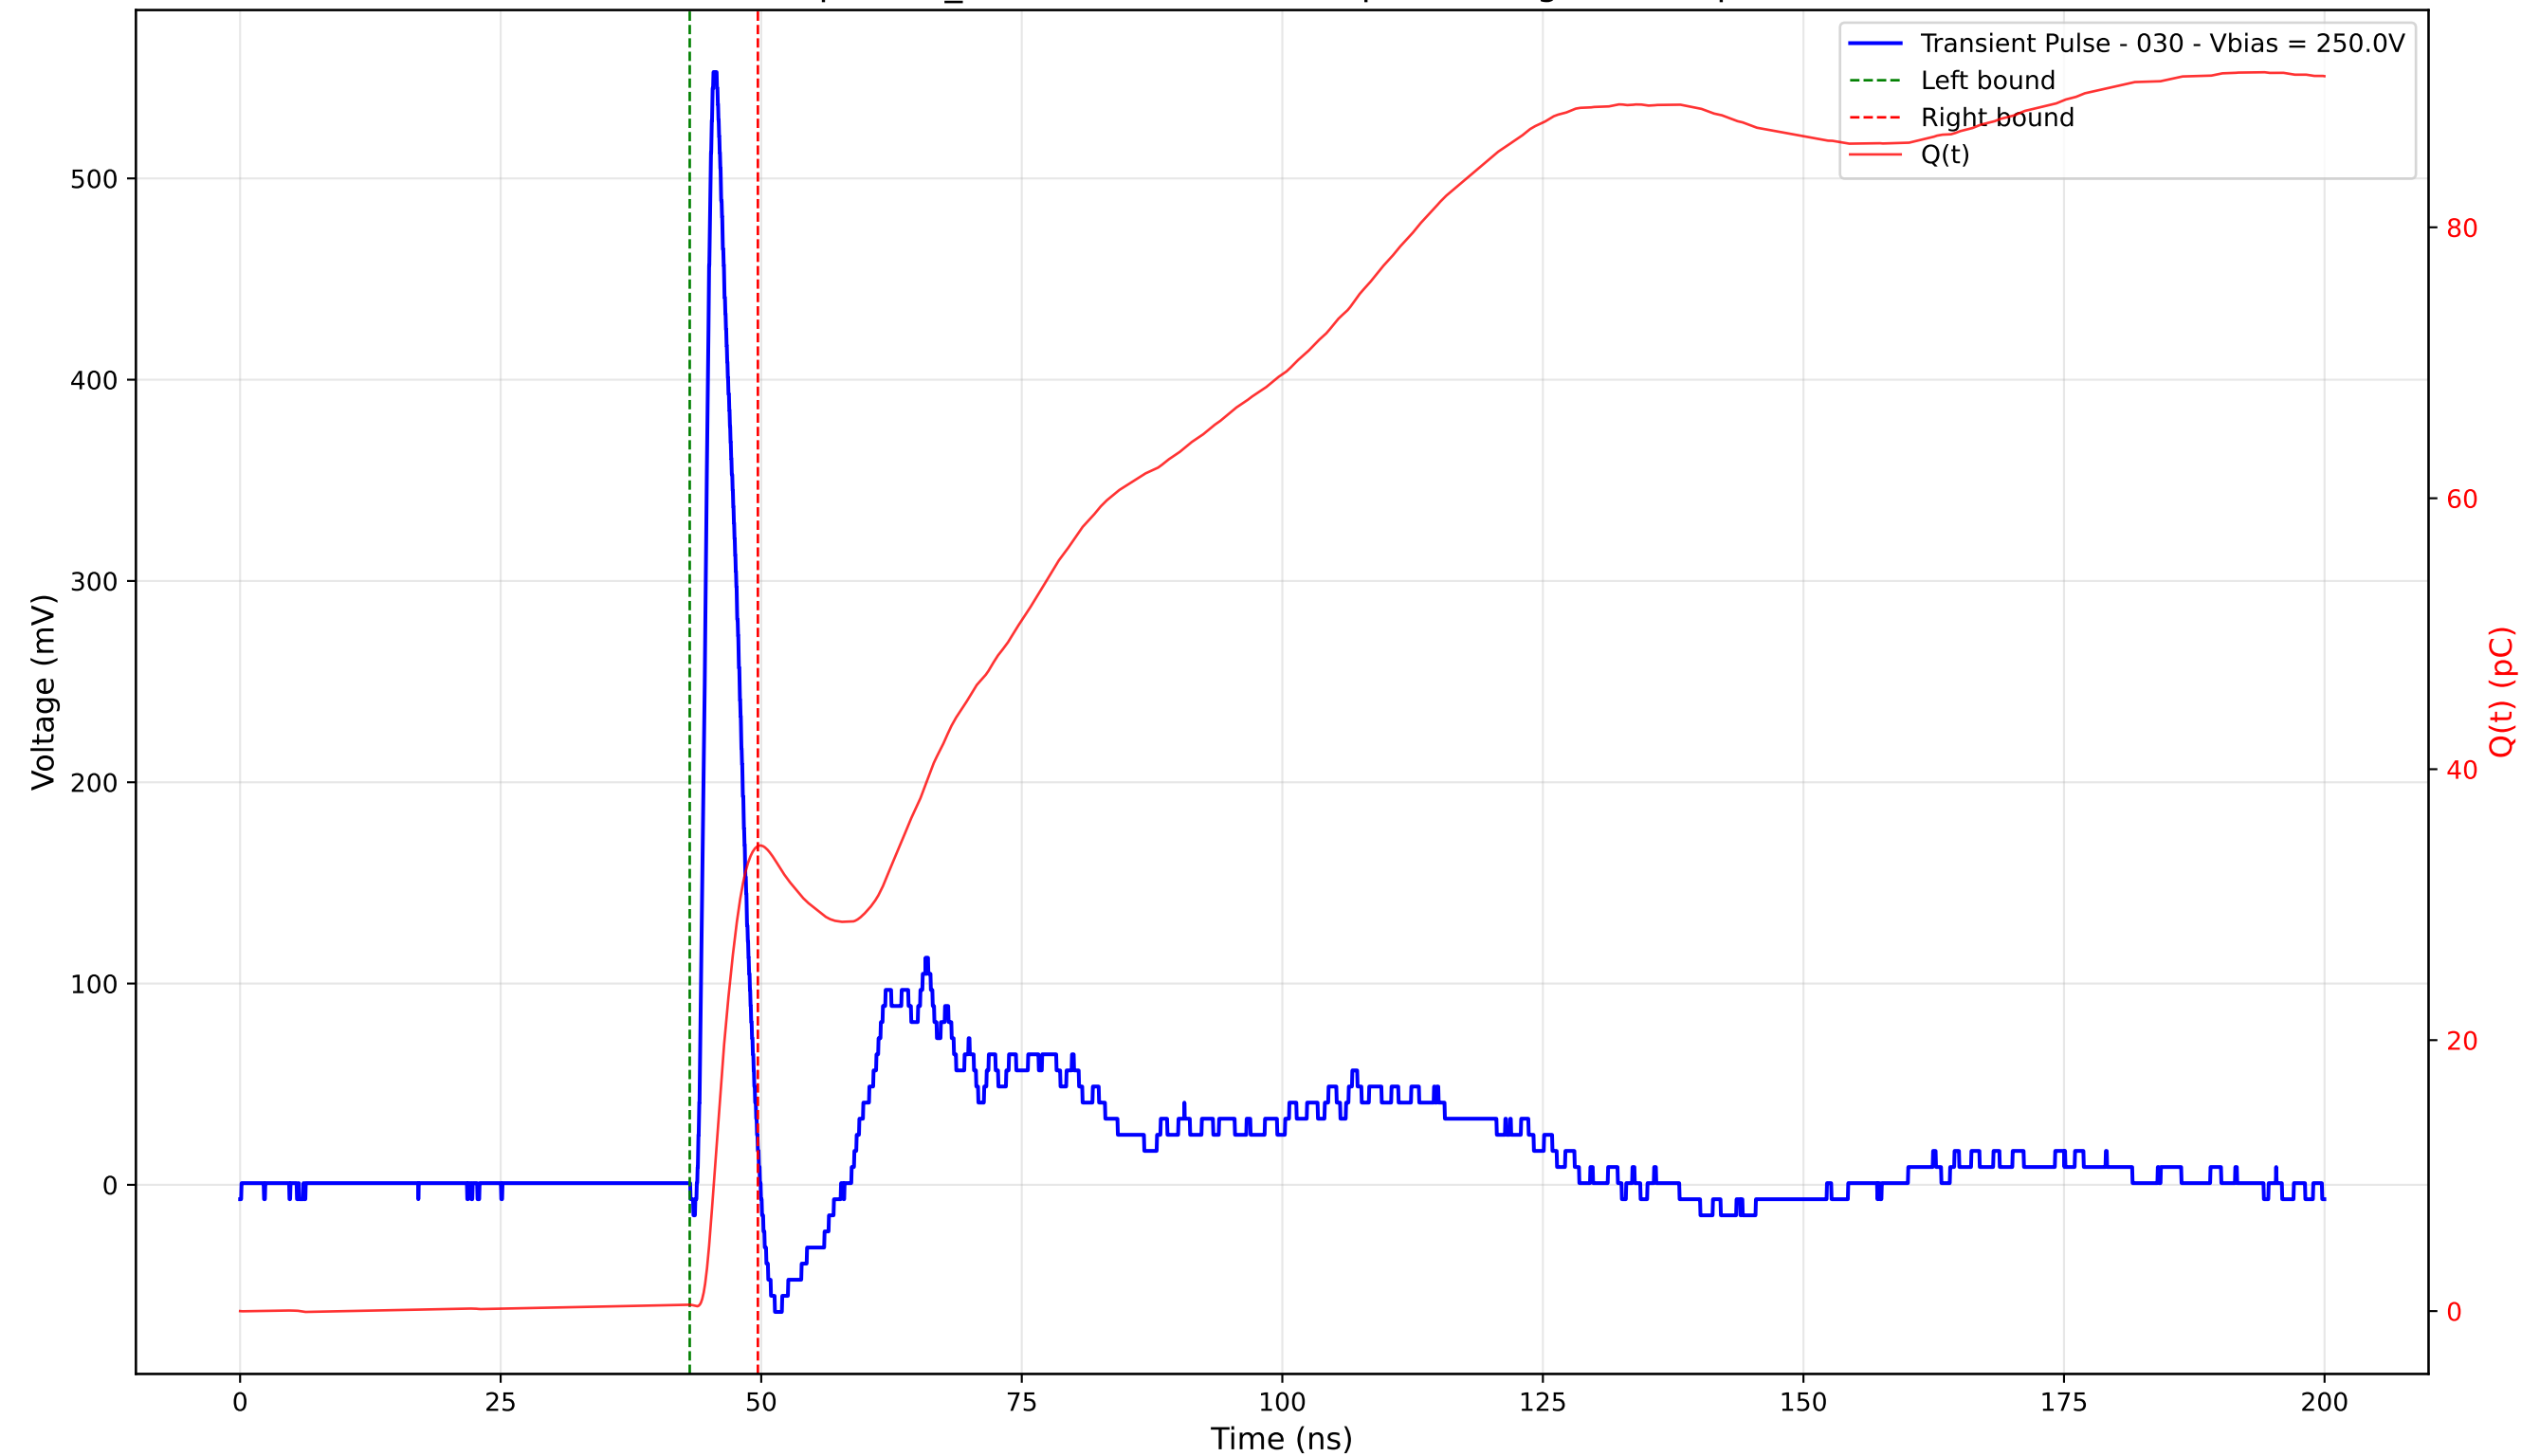


Transient Pulse - Sample: TD_4004 - Position: 365.0 μm - Charge: 32.76 pC - Rise Time: 1.03 ns

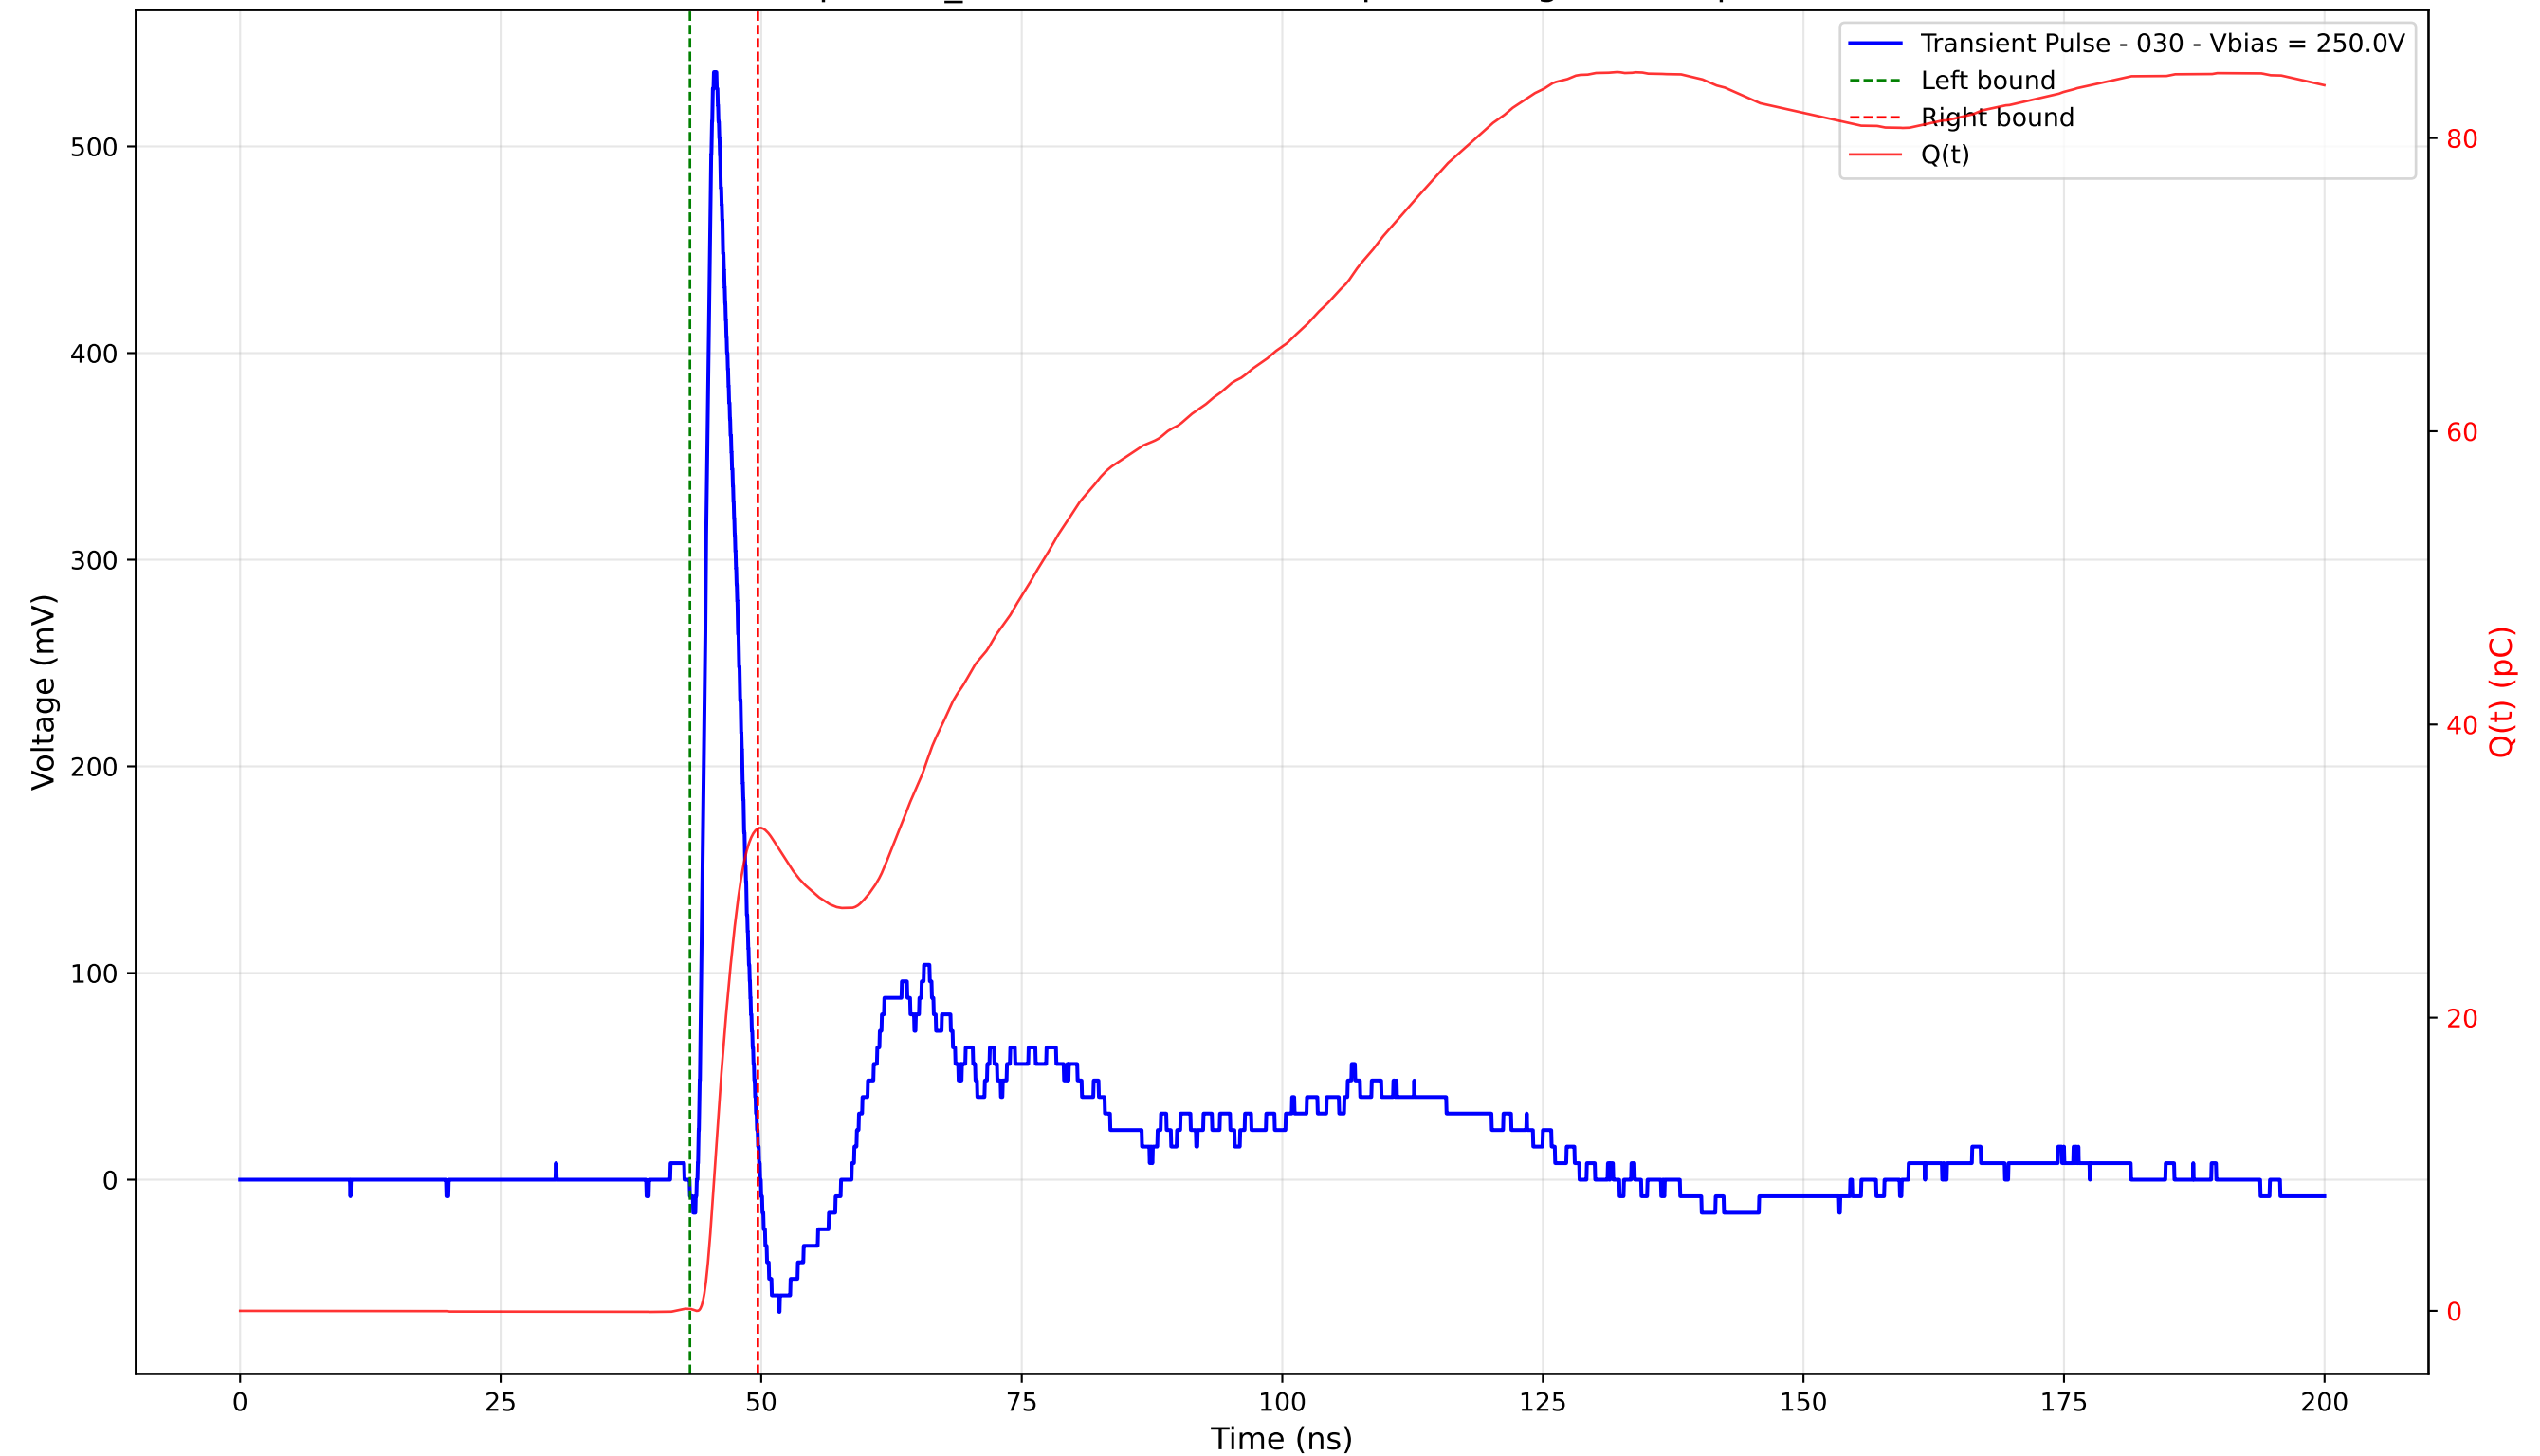


Transient Pulse - Sample: TD_4004 - Position: 370.0 μm - Charge: 32.20 pC - Rise Time: 1.05 ns

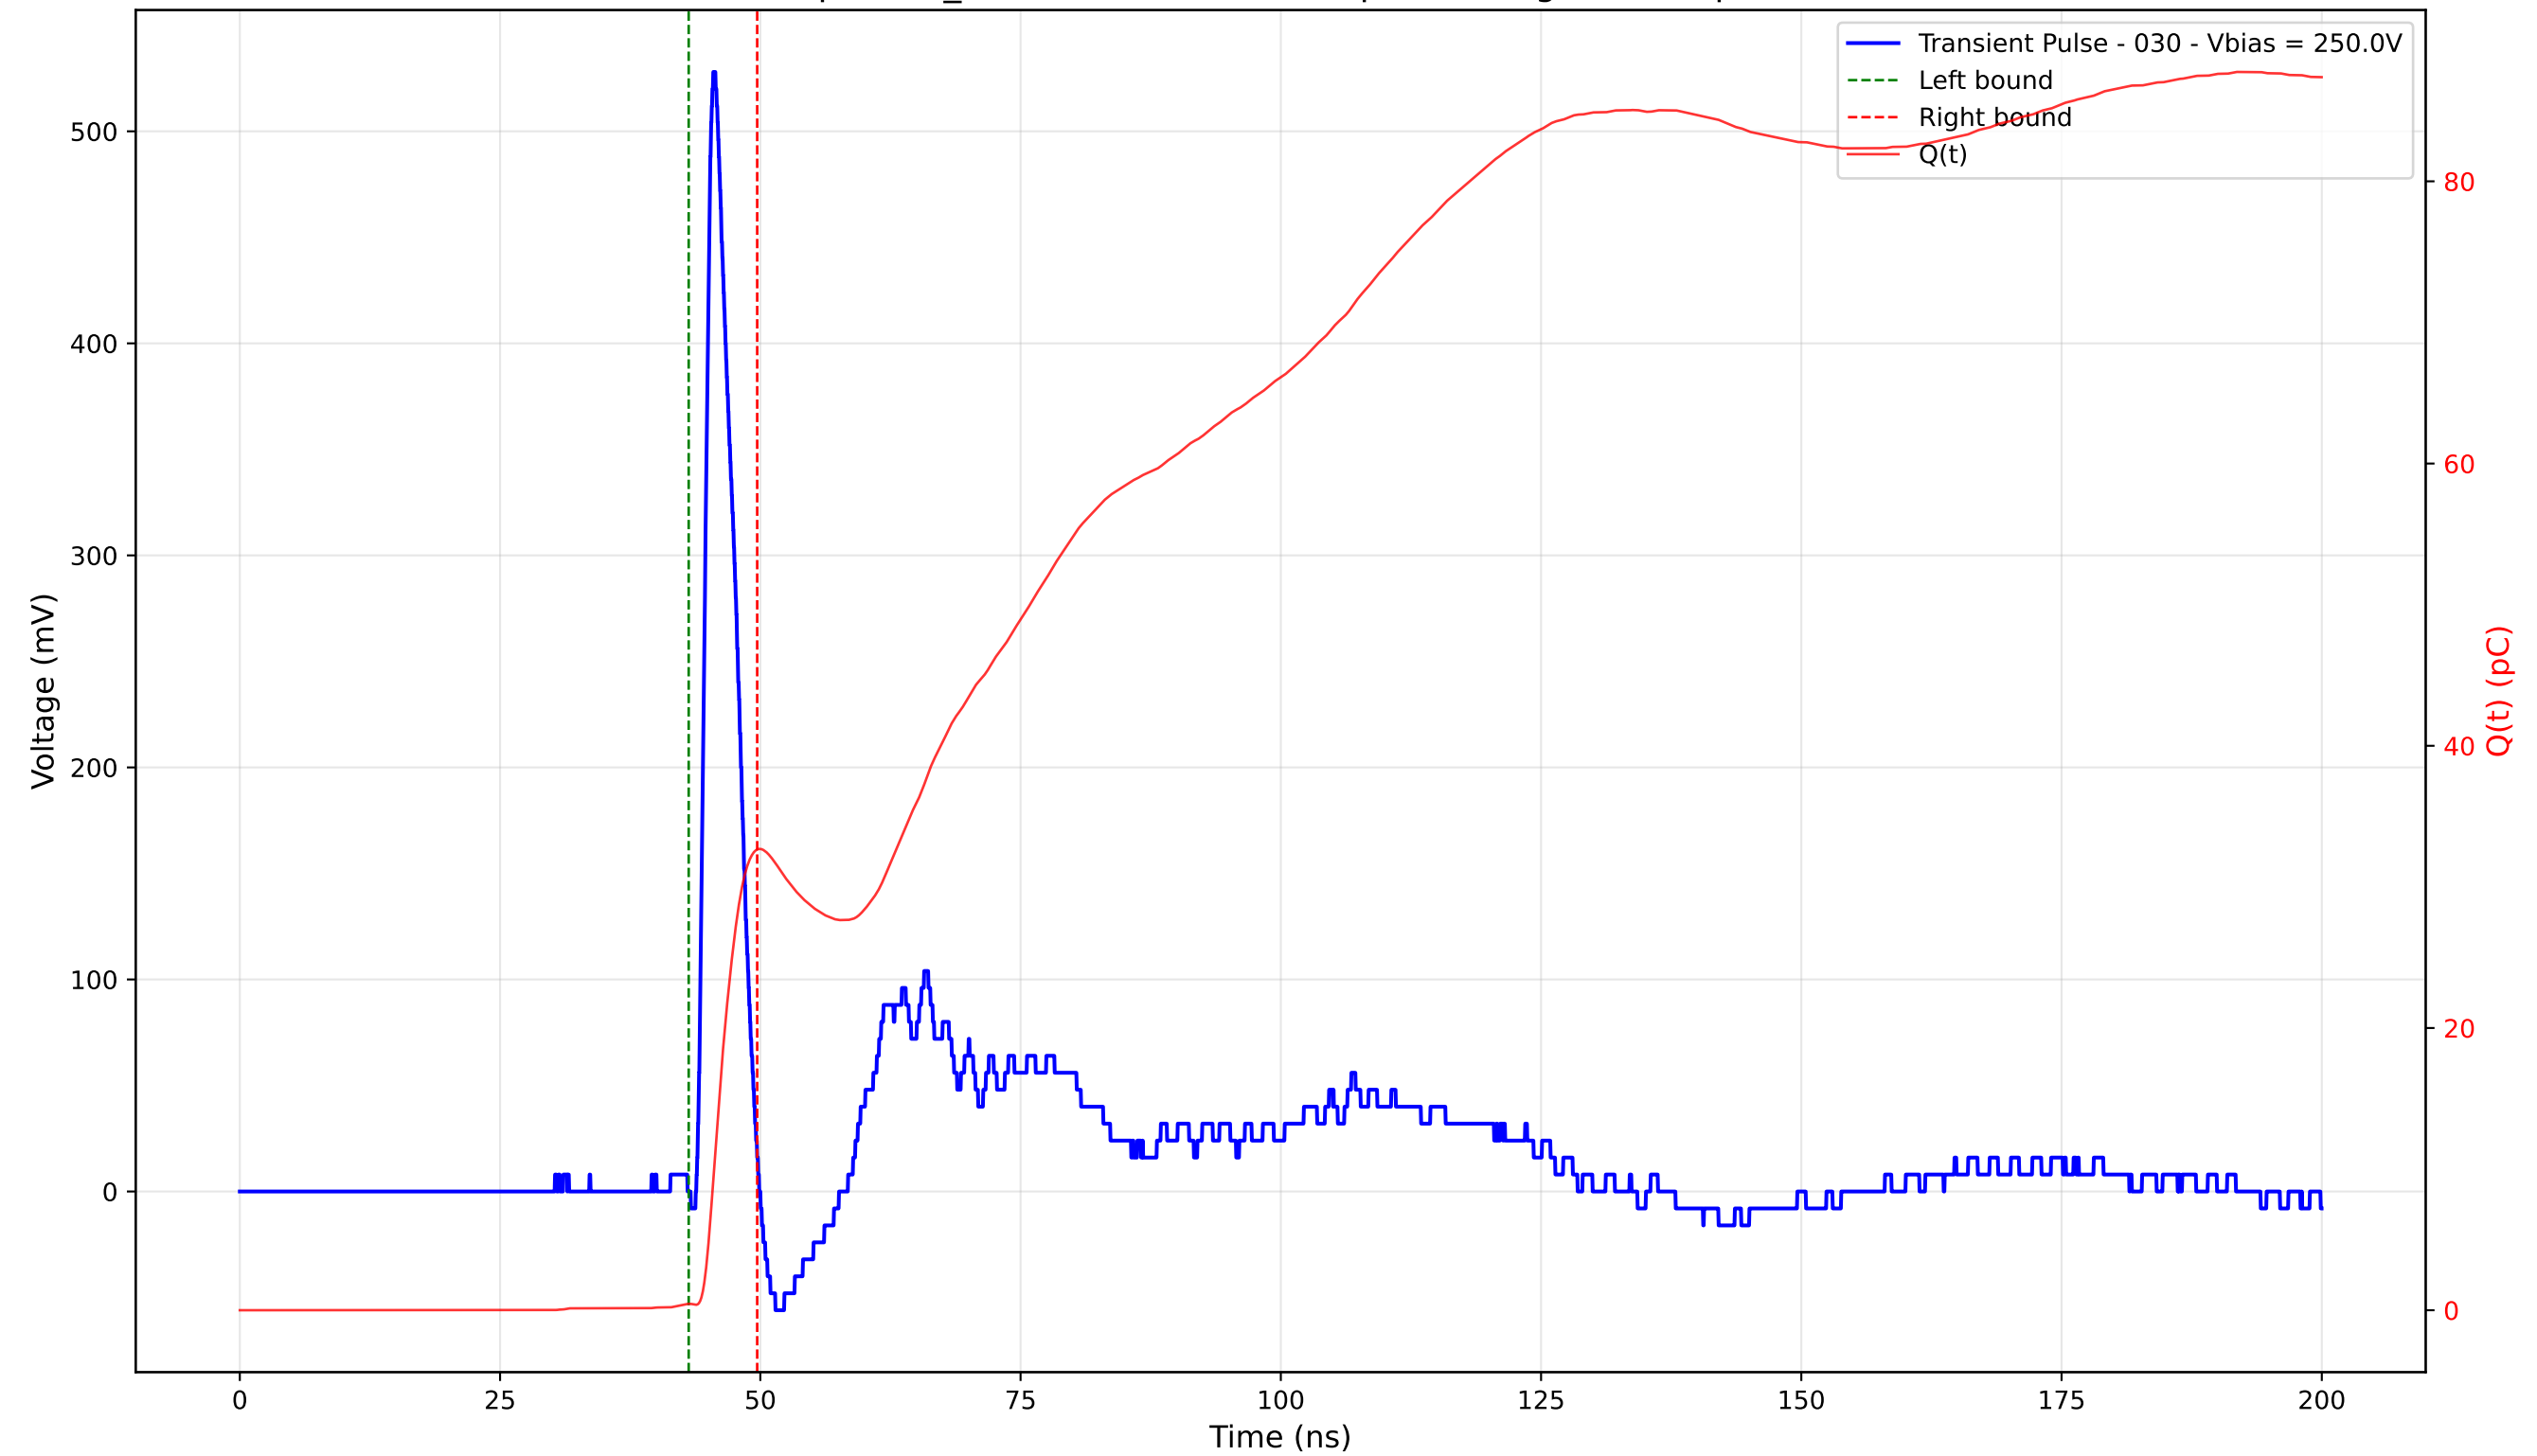


Transient Pulse - Sample: TD_4004 - Position: 375.0 μm - Charge: 31.56 pC - Rise Time: 1.03 ns

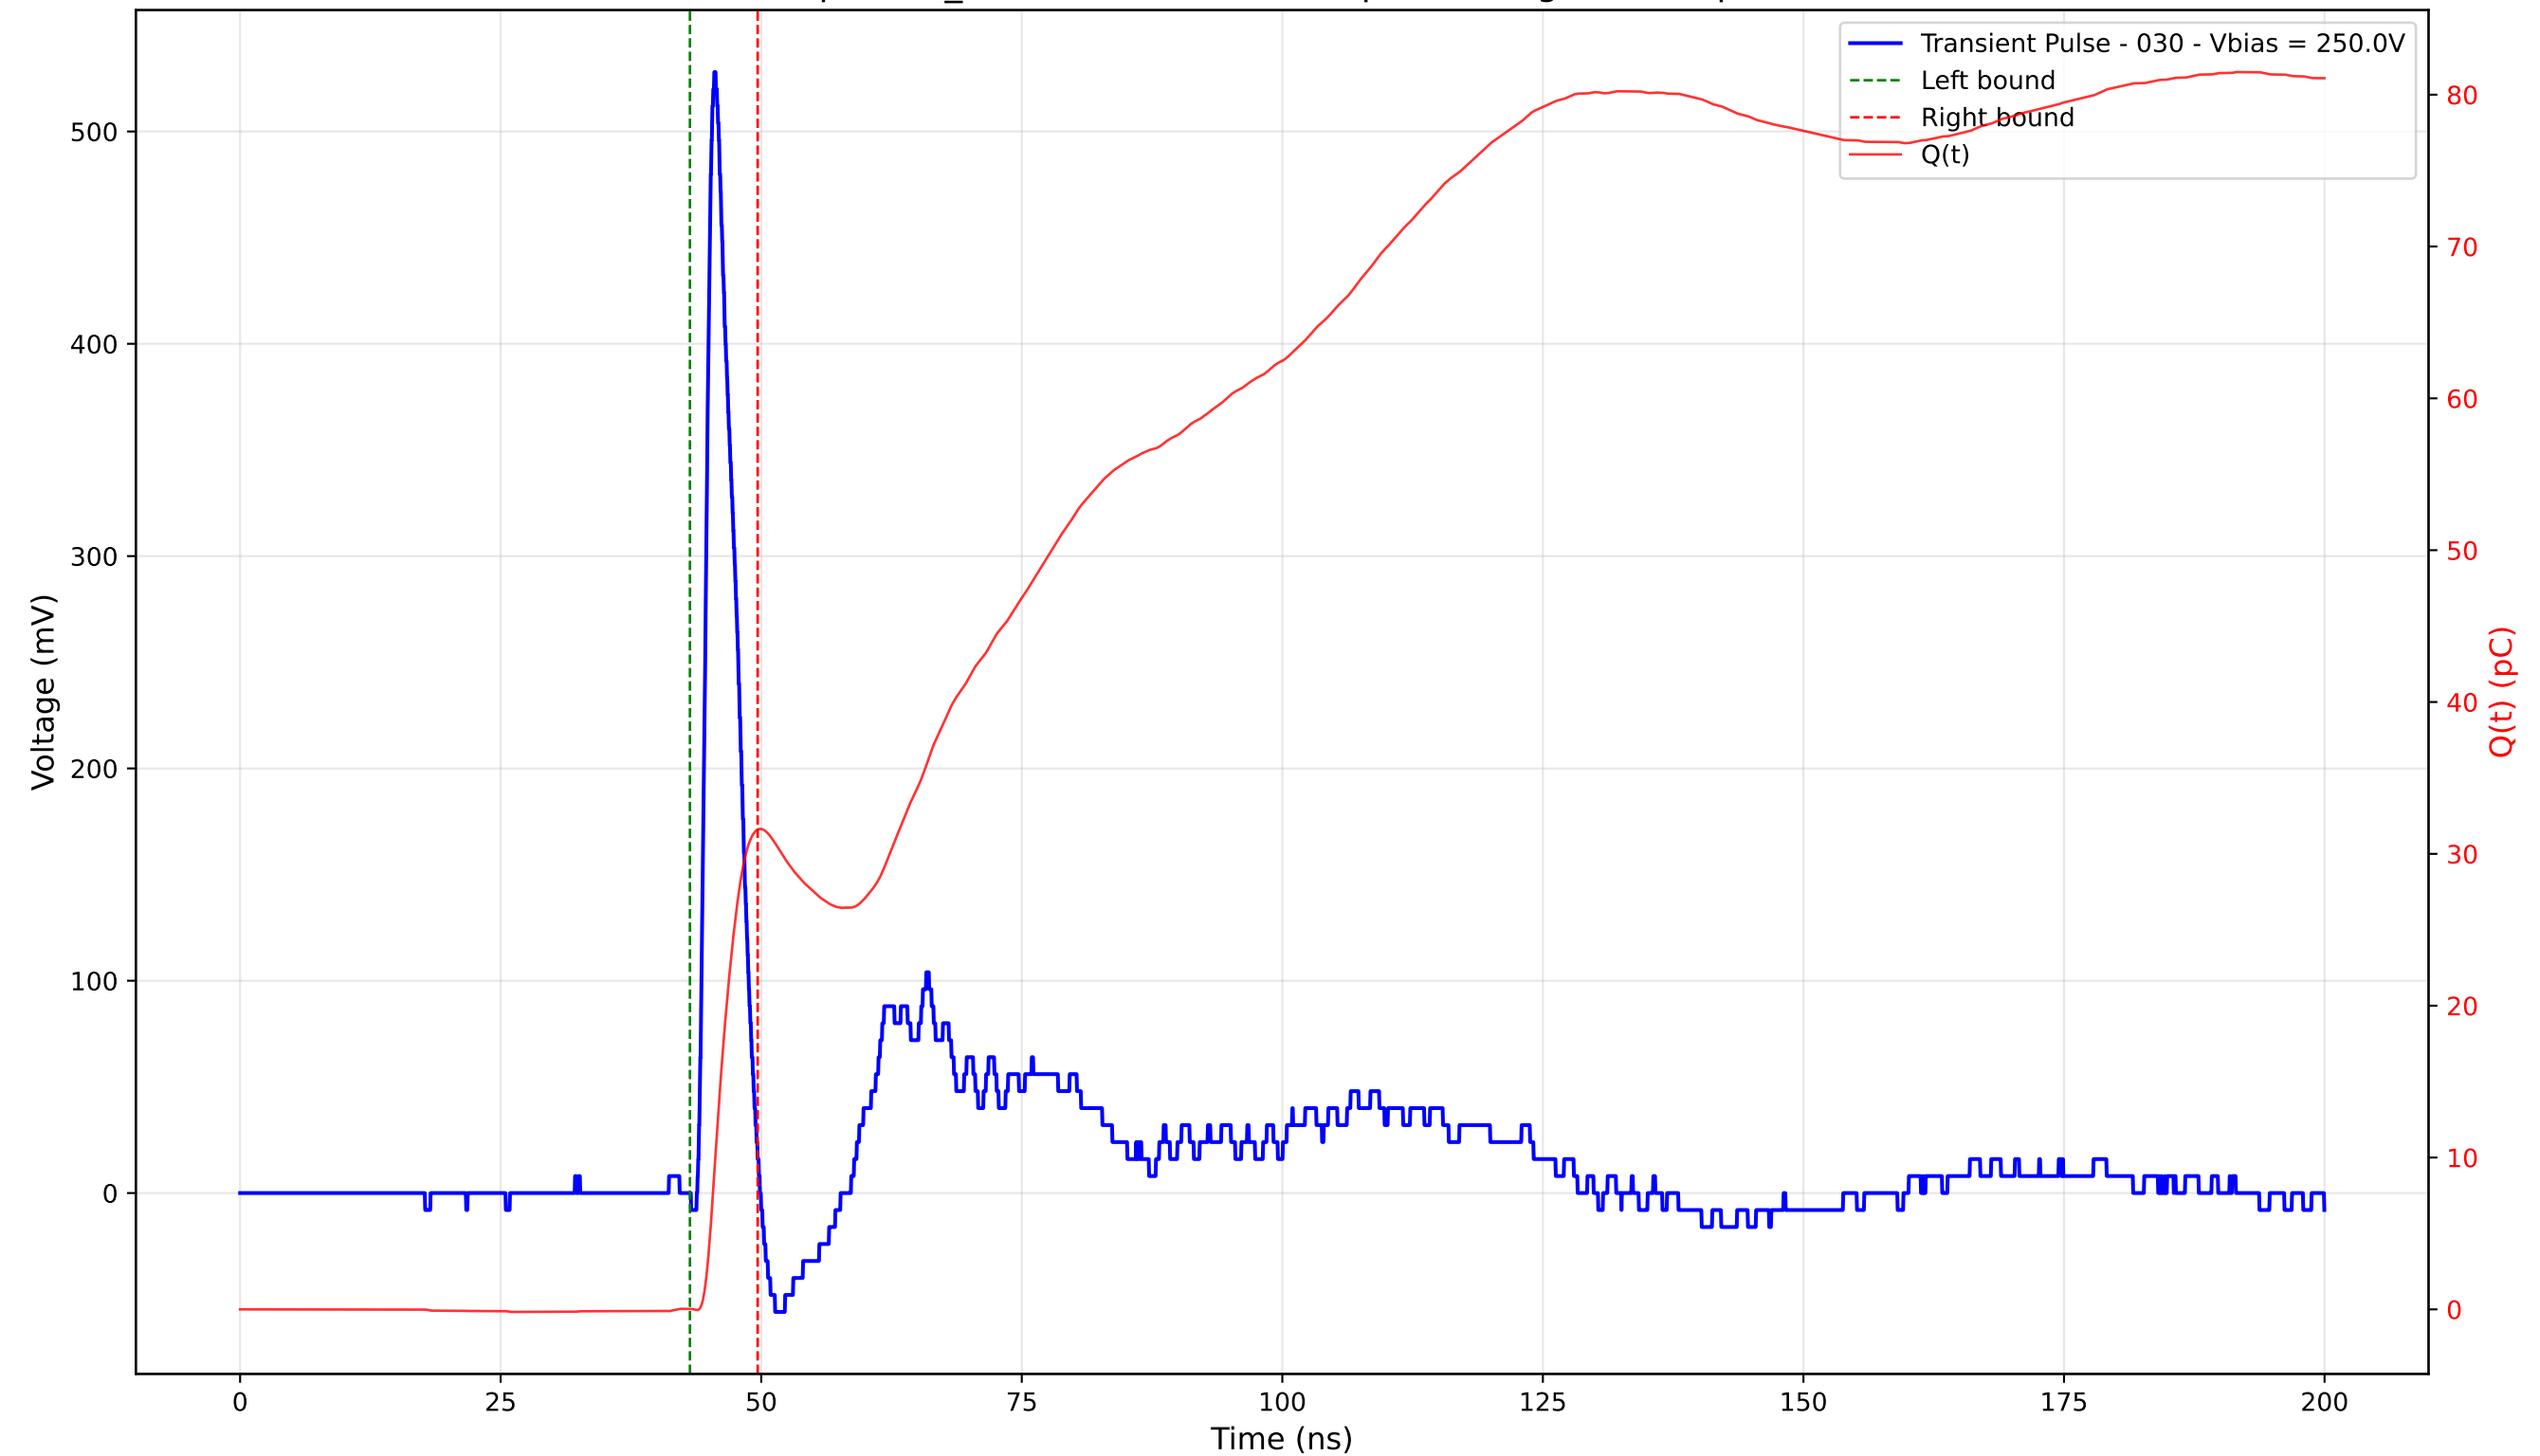


Transient Pulse - Sample: TD_4004 - Position: 380.0 μm - Charge: 31.09 pC - Rise Time: 1.03 ns

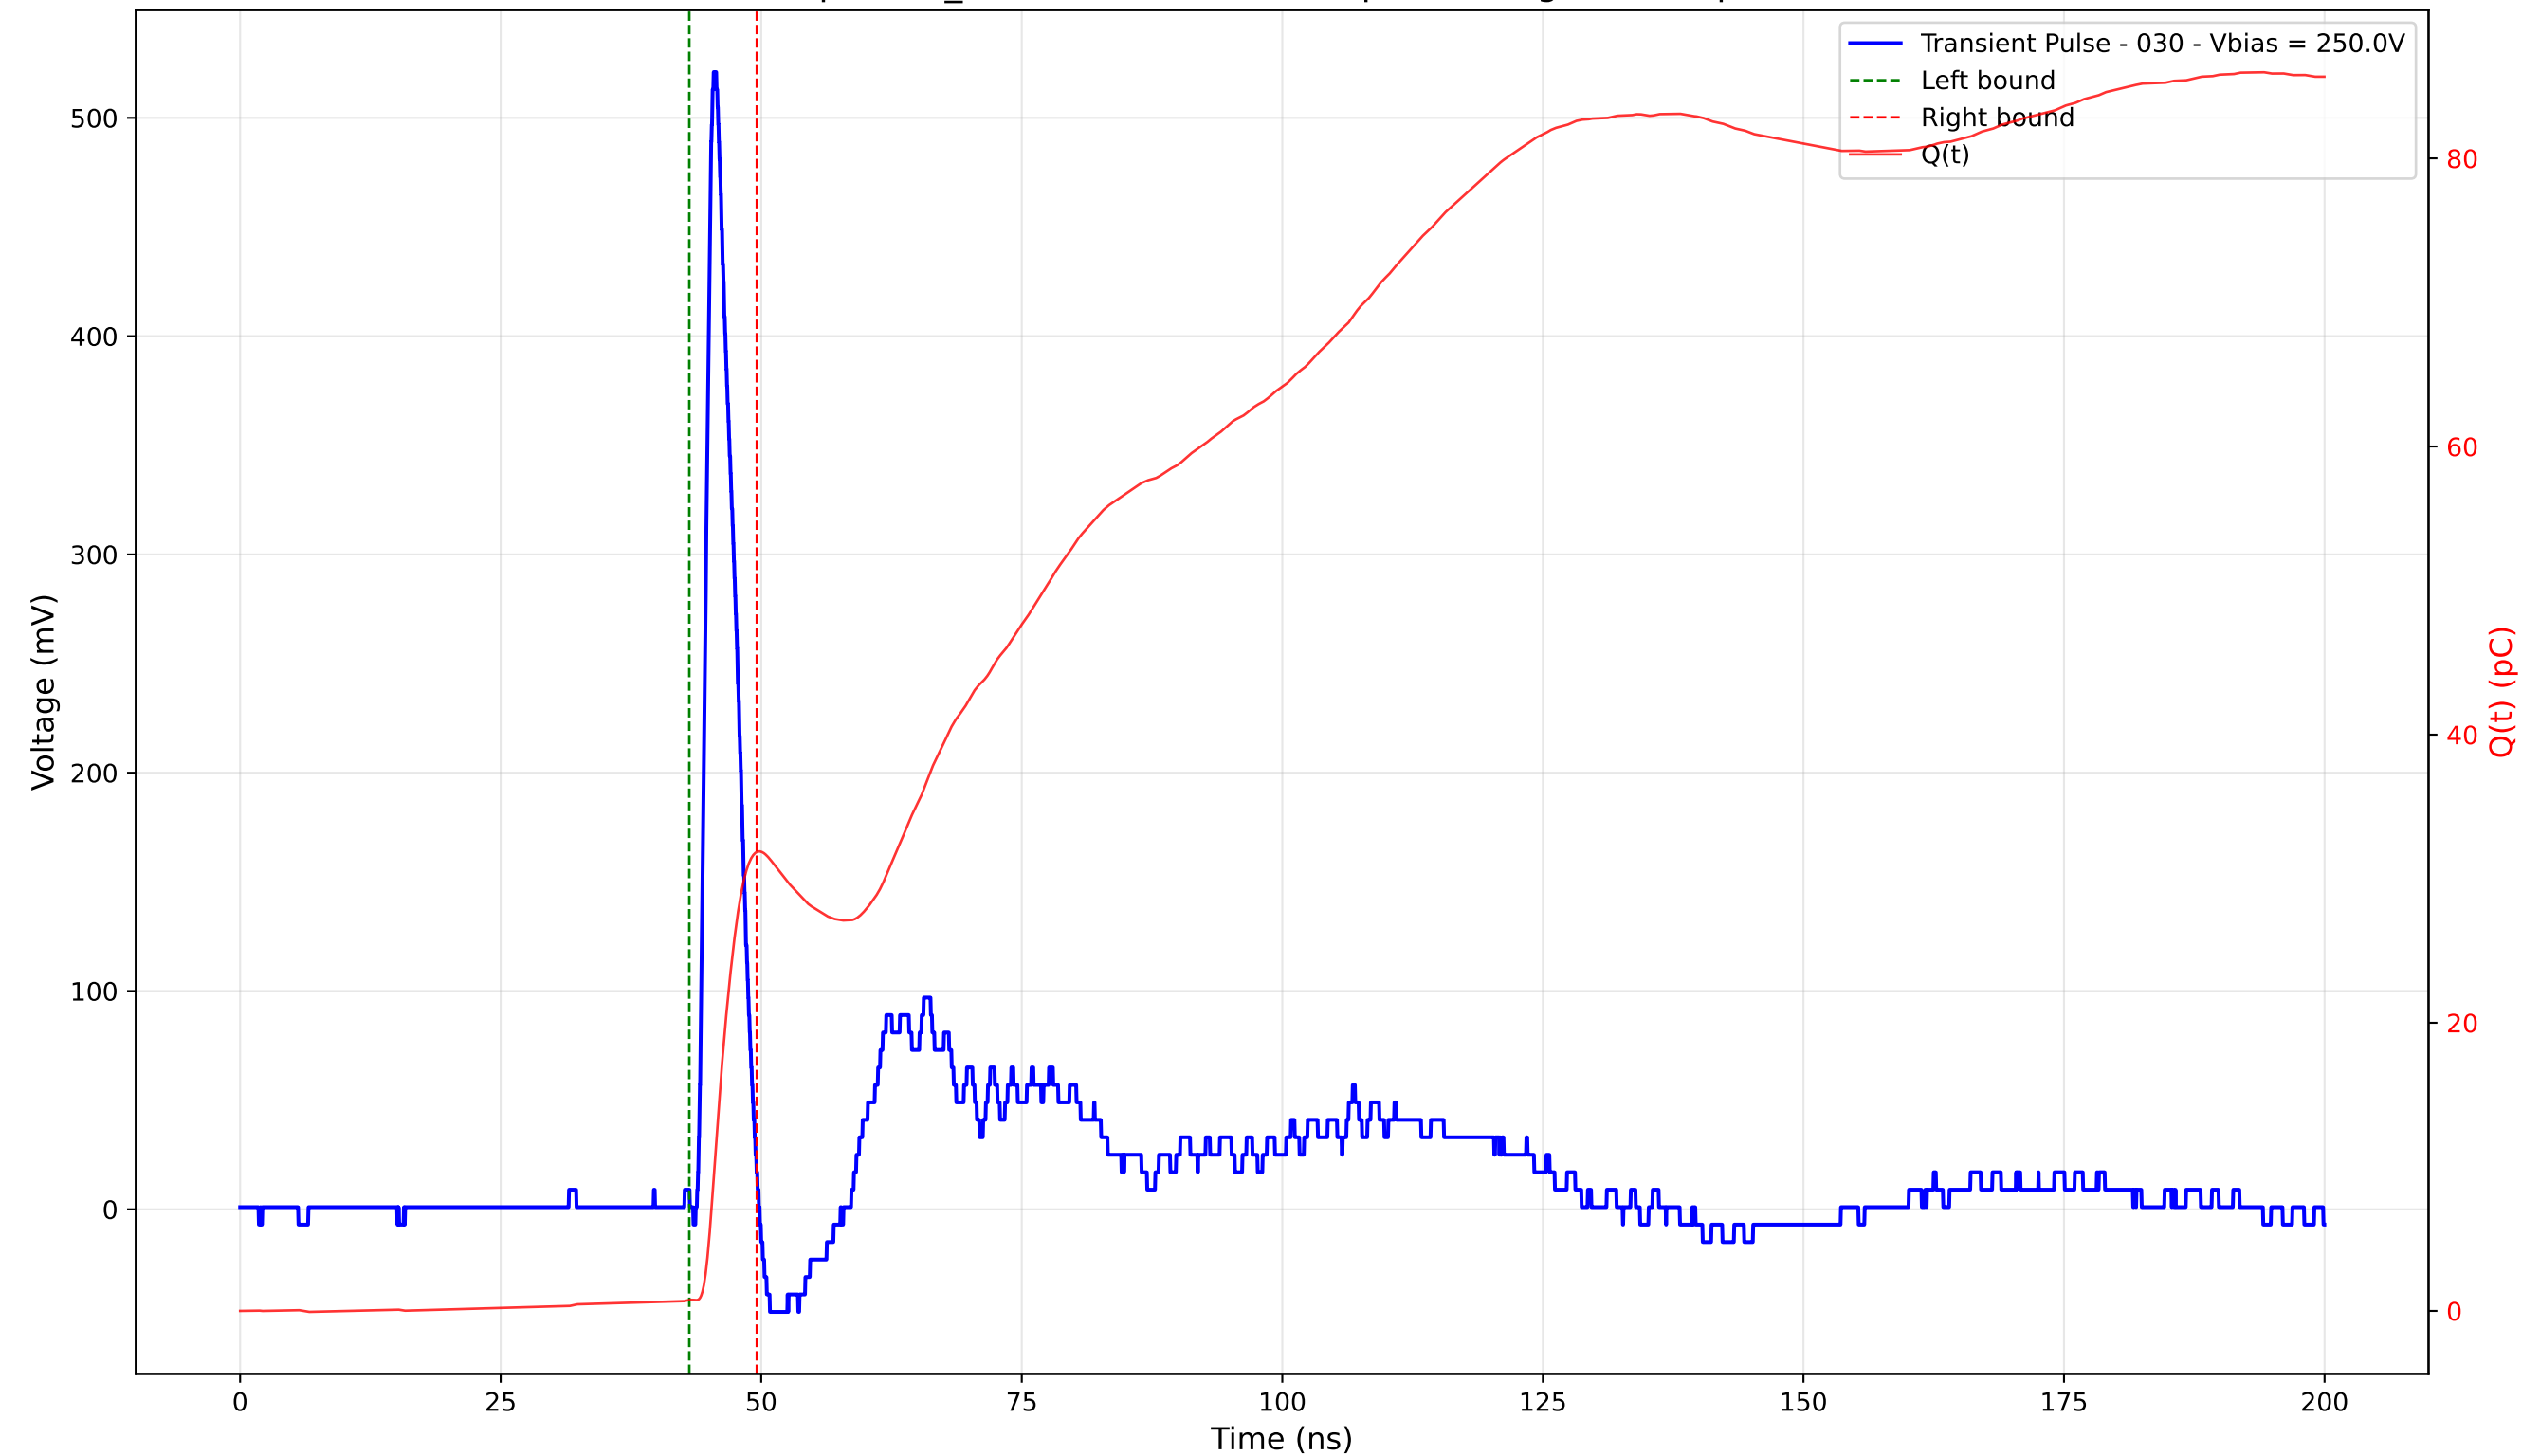


Transient Pulse - Sample: TD_4004 - Position: 385.0 μm - Charge: 28.83 pC - Rise Time: 1.03 ns

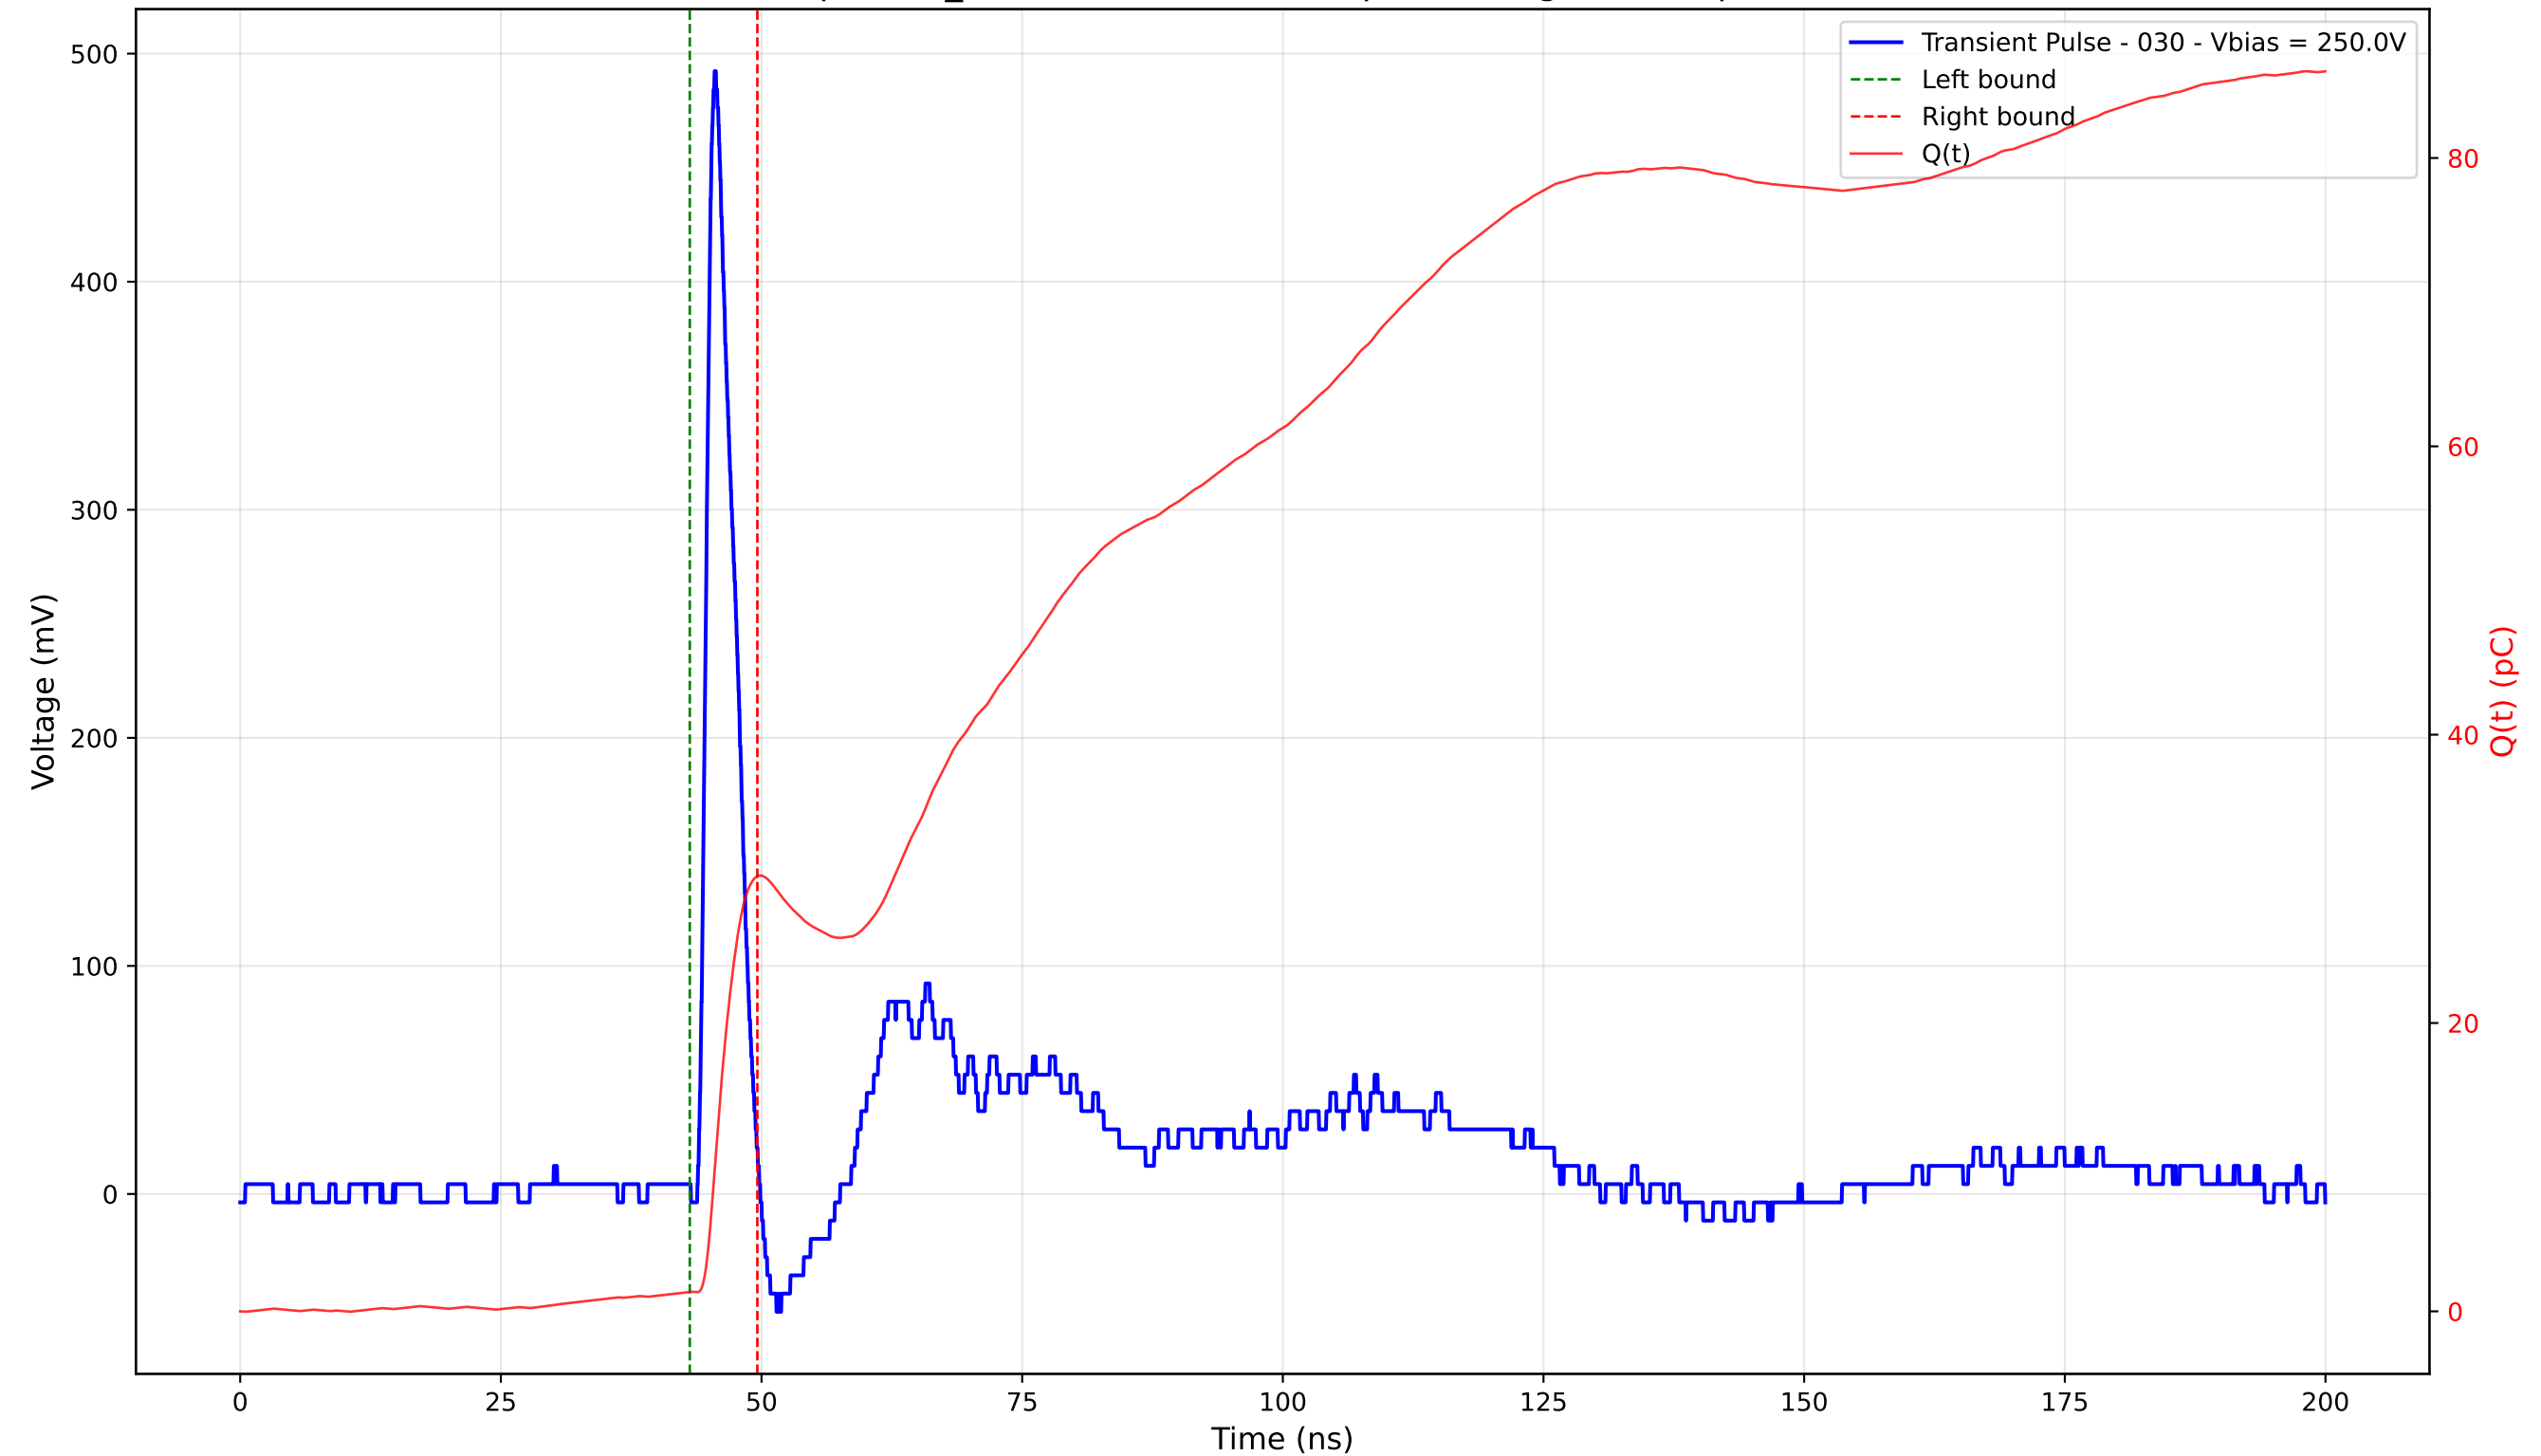


Transient Pulse - Sample: TD_4004 - Position: 390.0 μm - Charge: 24.73 pC - Rise Time: 1.02 ns

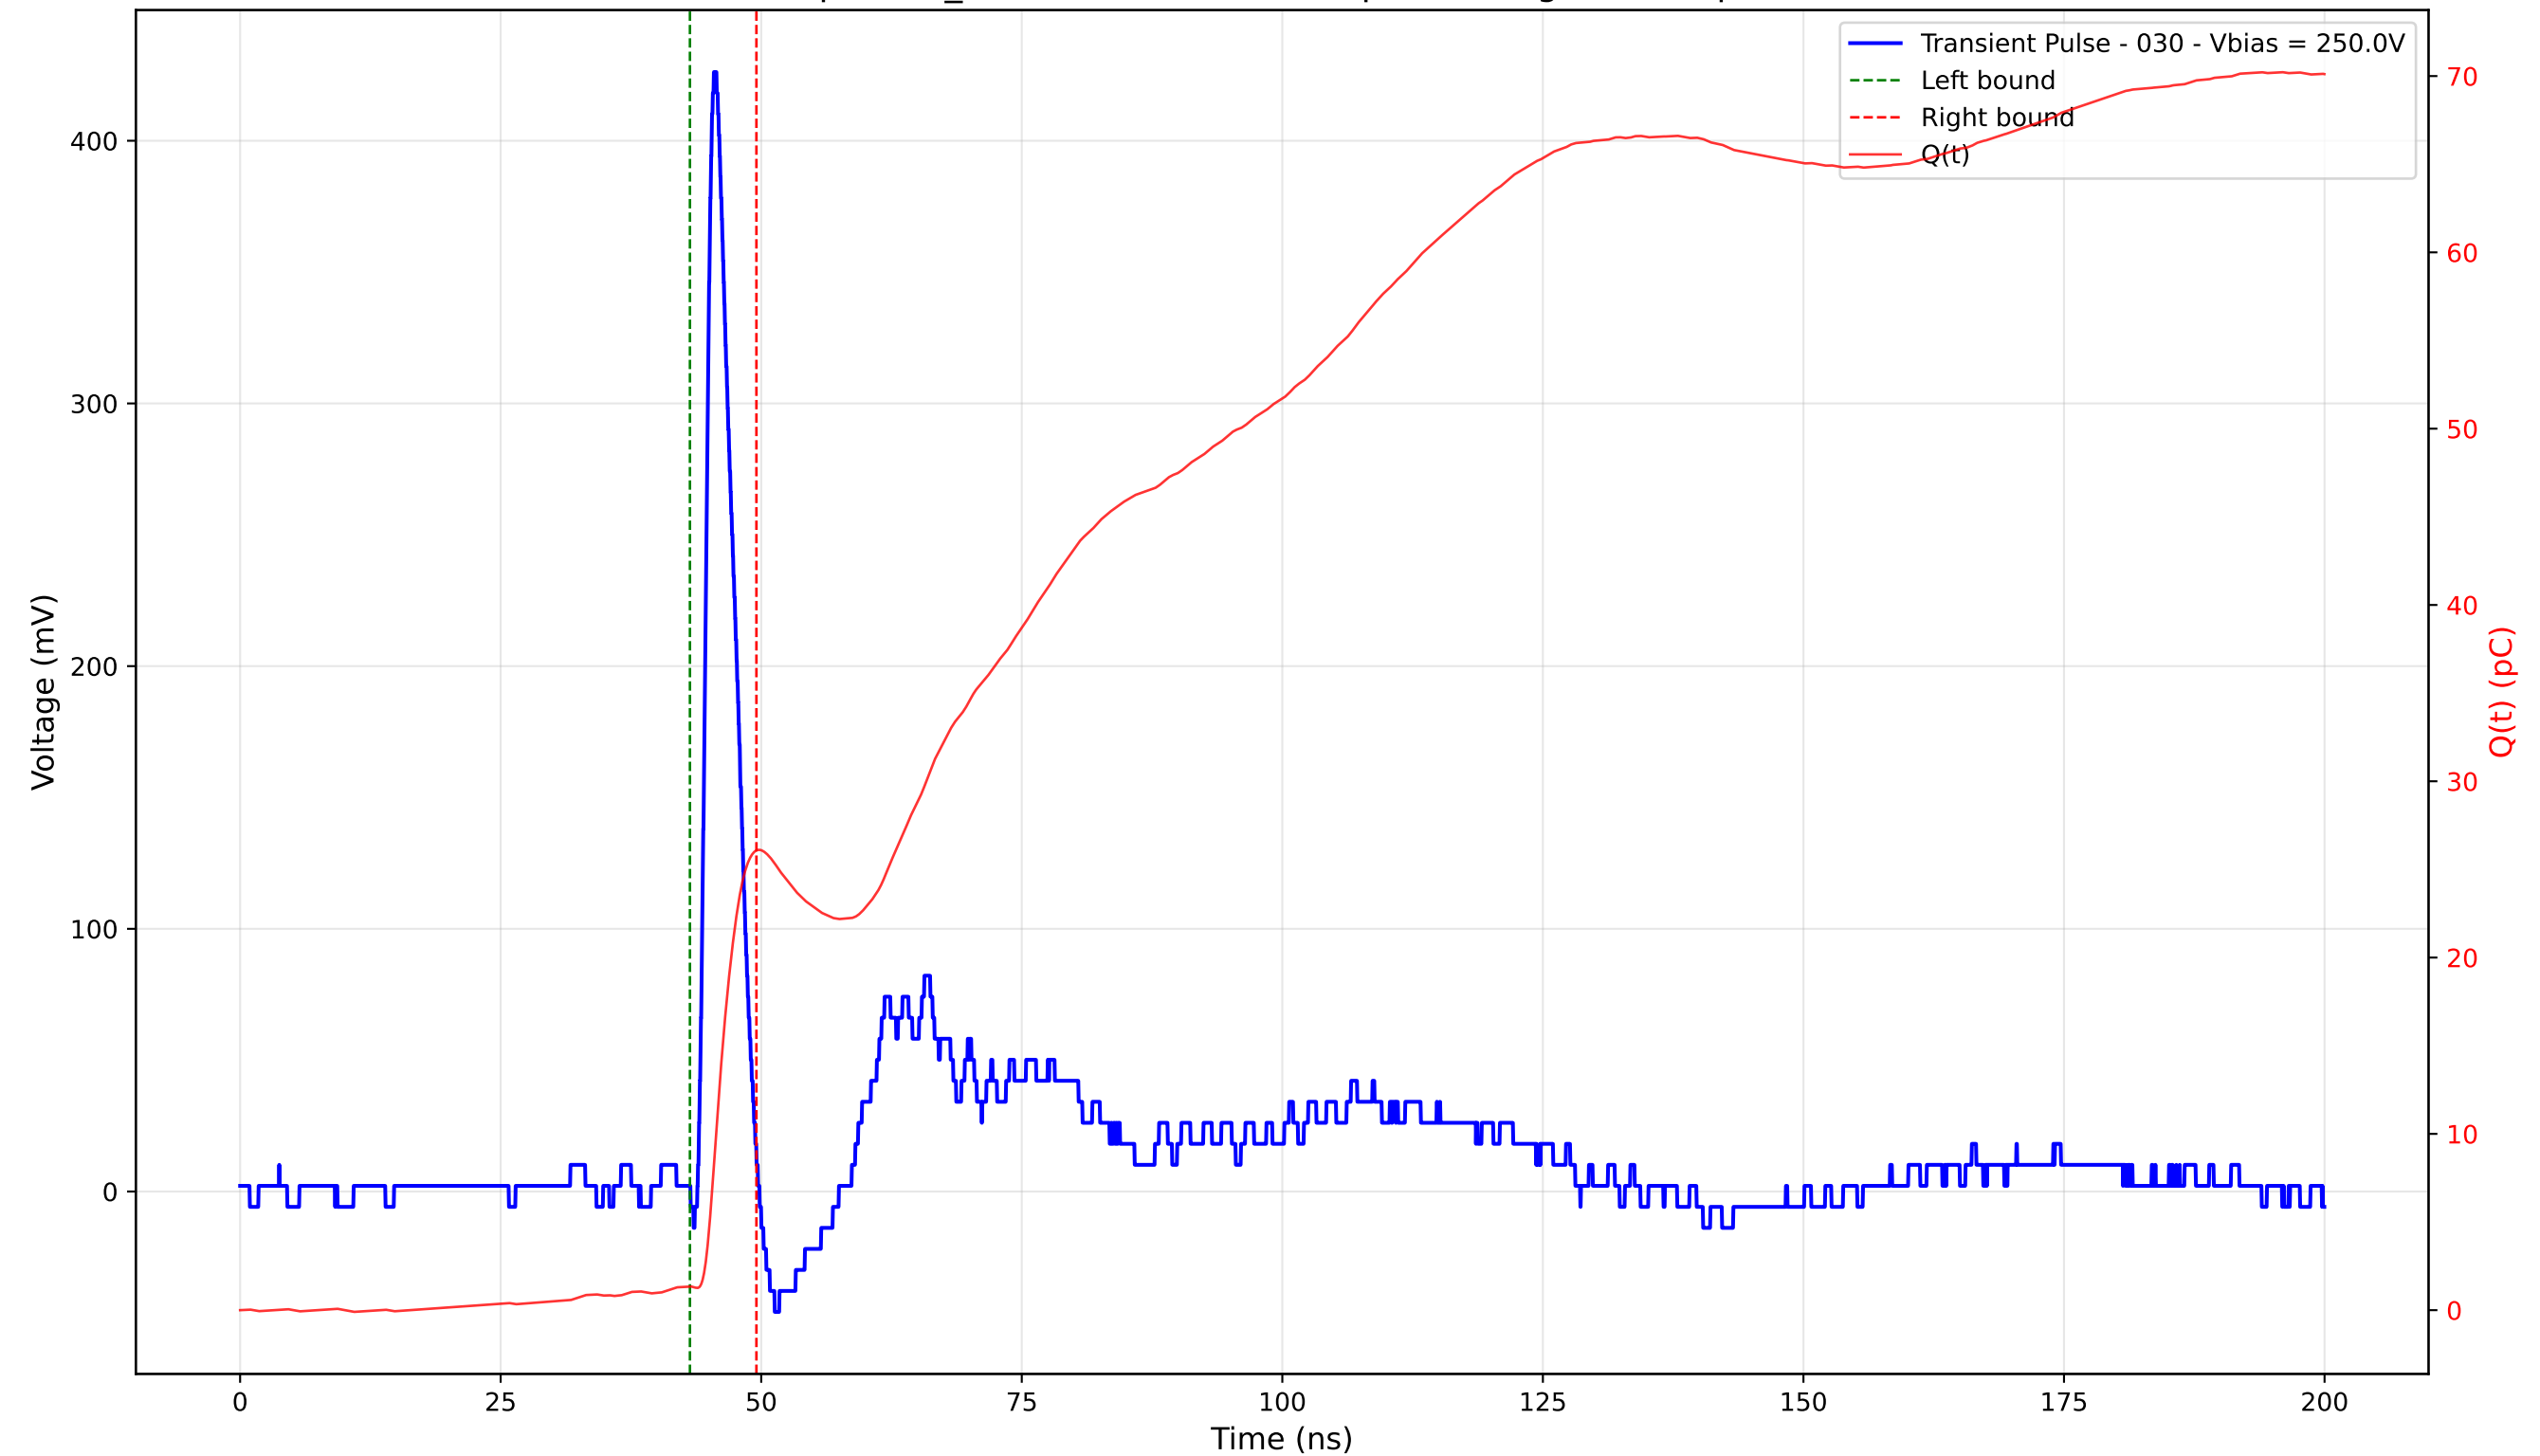


Transient Pulse - Sample: TD_4004 - Position: 395.0 μm - Charge: 20.56 pC - Rise Time: 1.02 ns

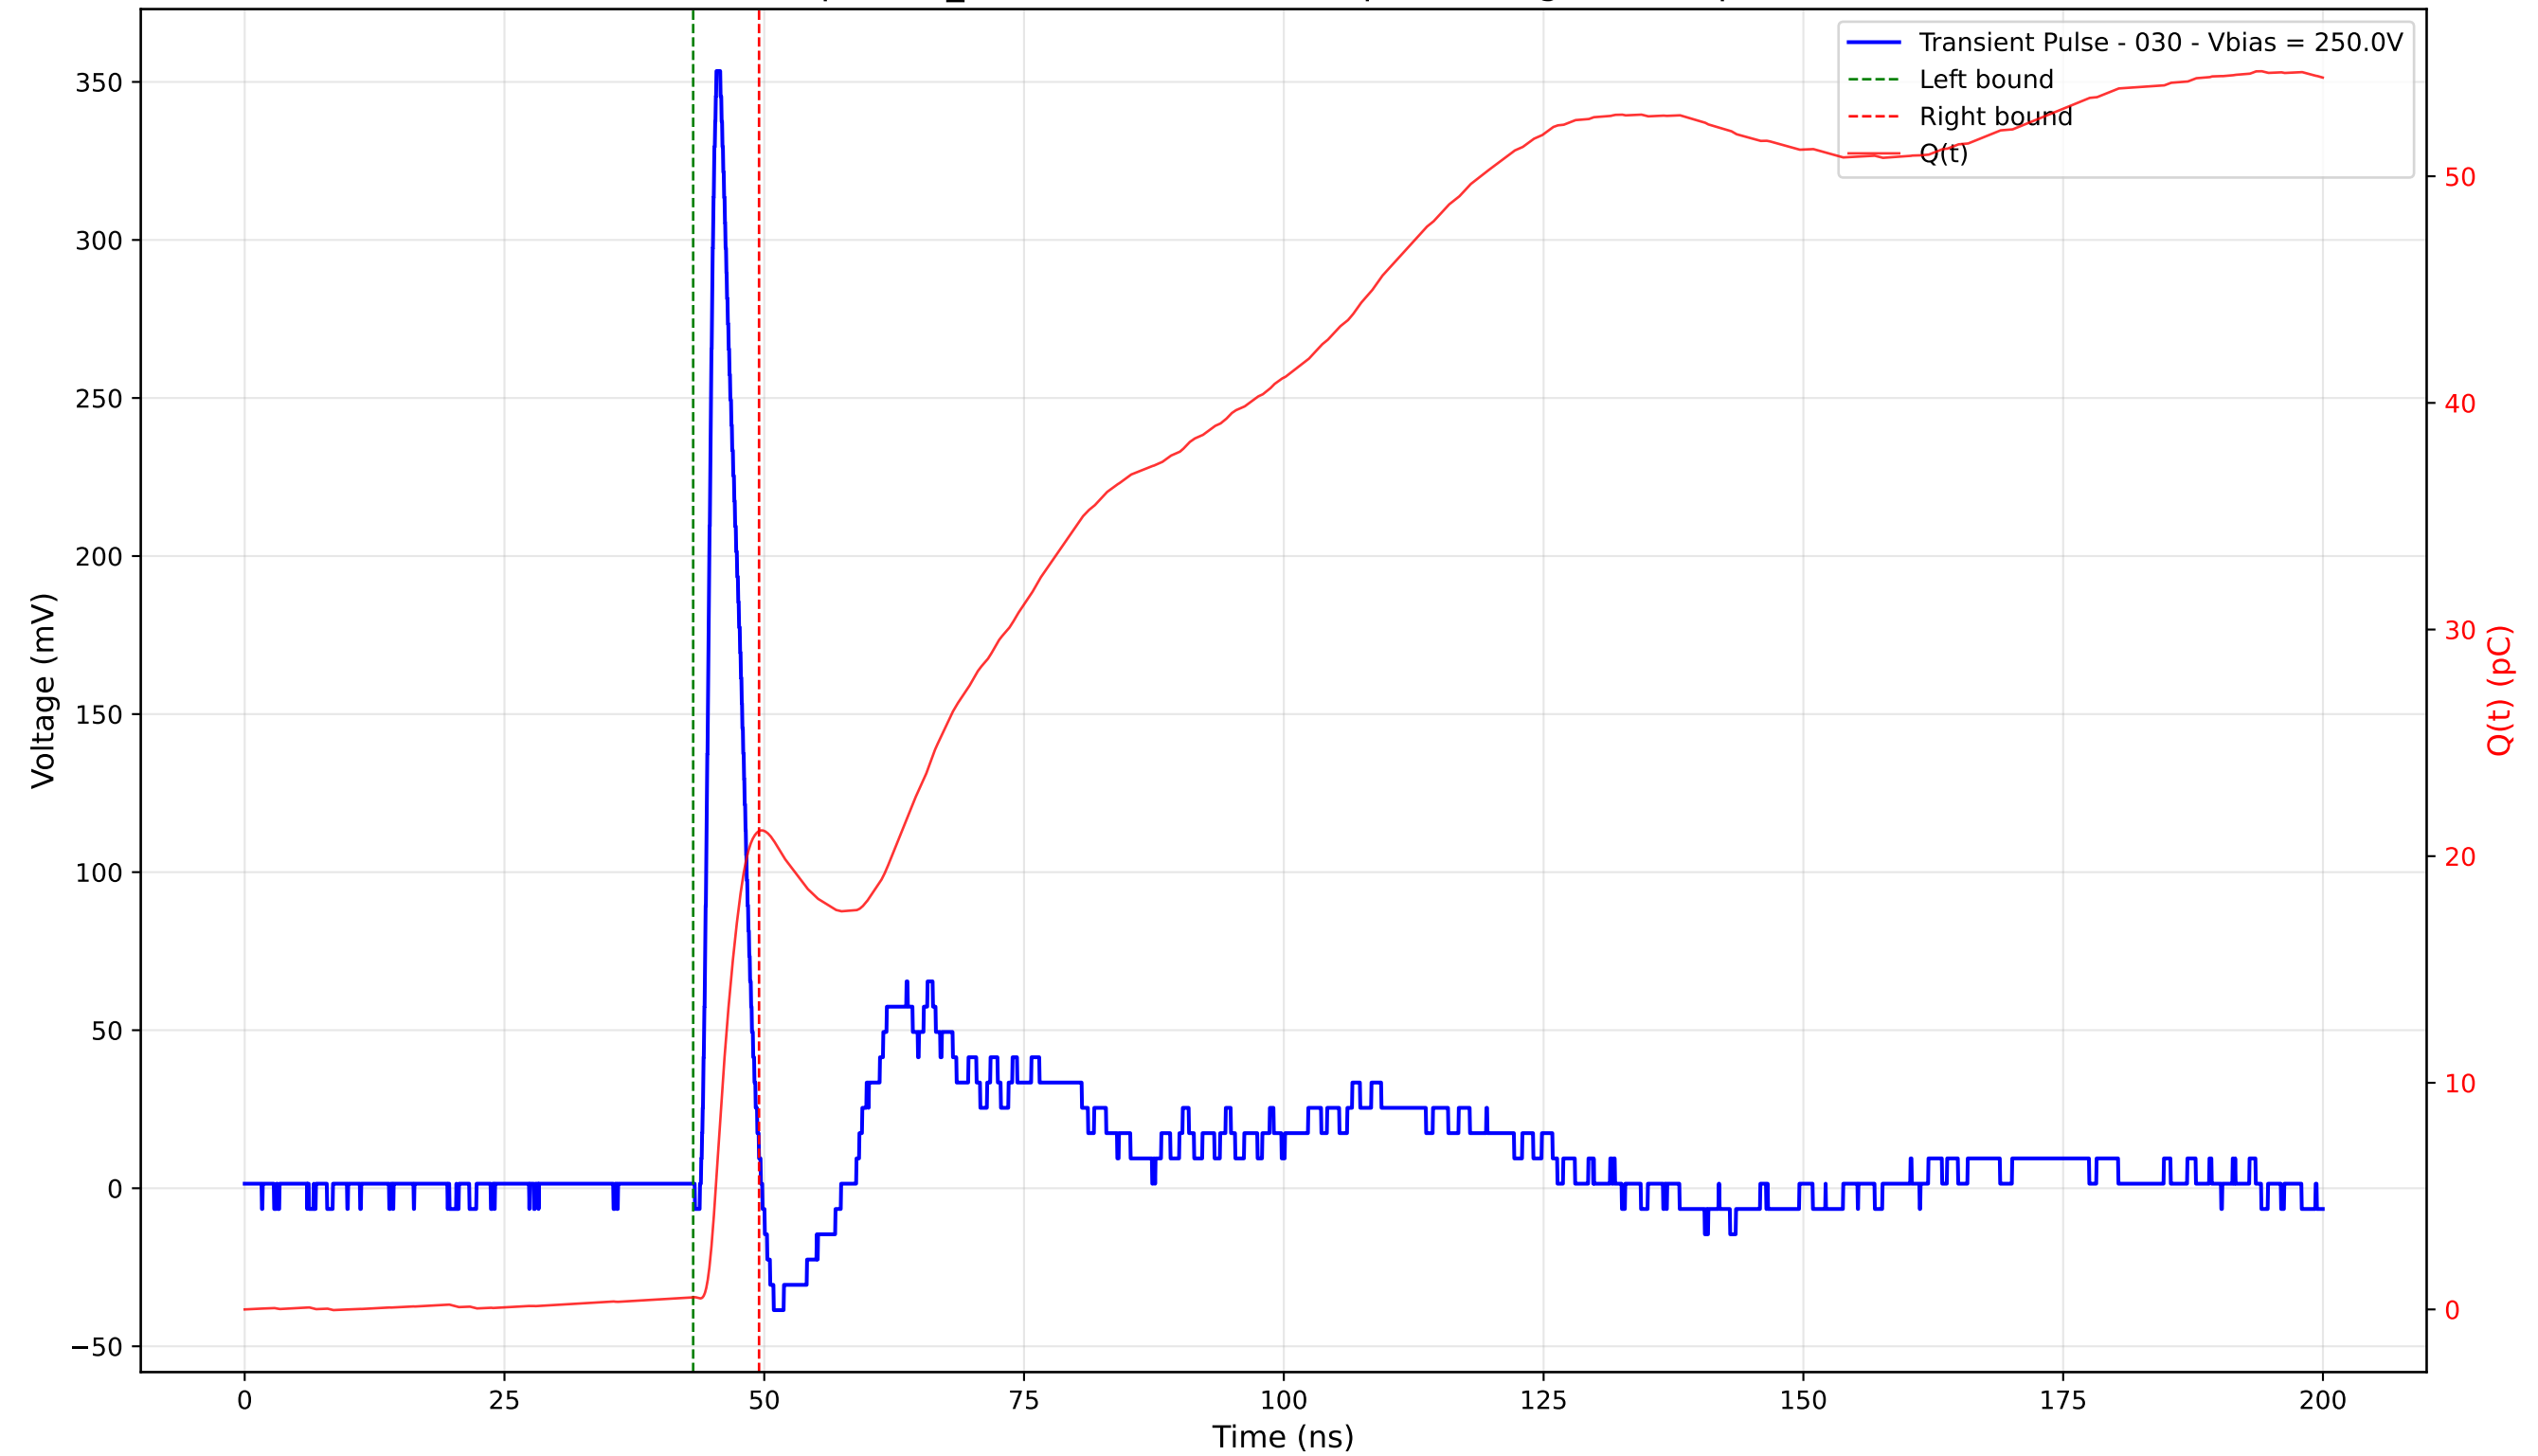


Transient Pulse - Sample: TD_4004 - Position: 400.0 μm - Charge: 16.58 pC - Rise Time: 1.01 ns

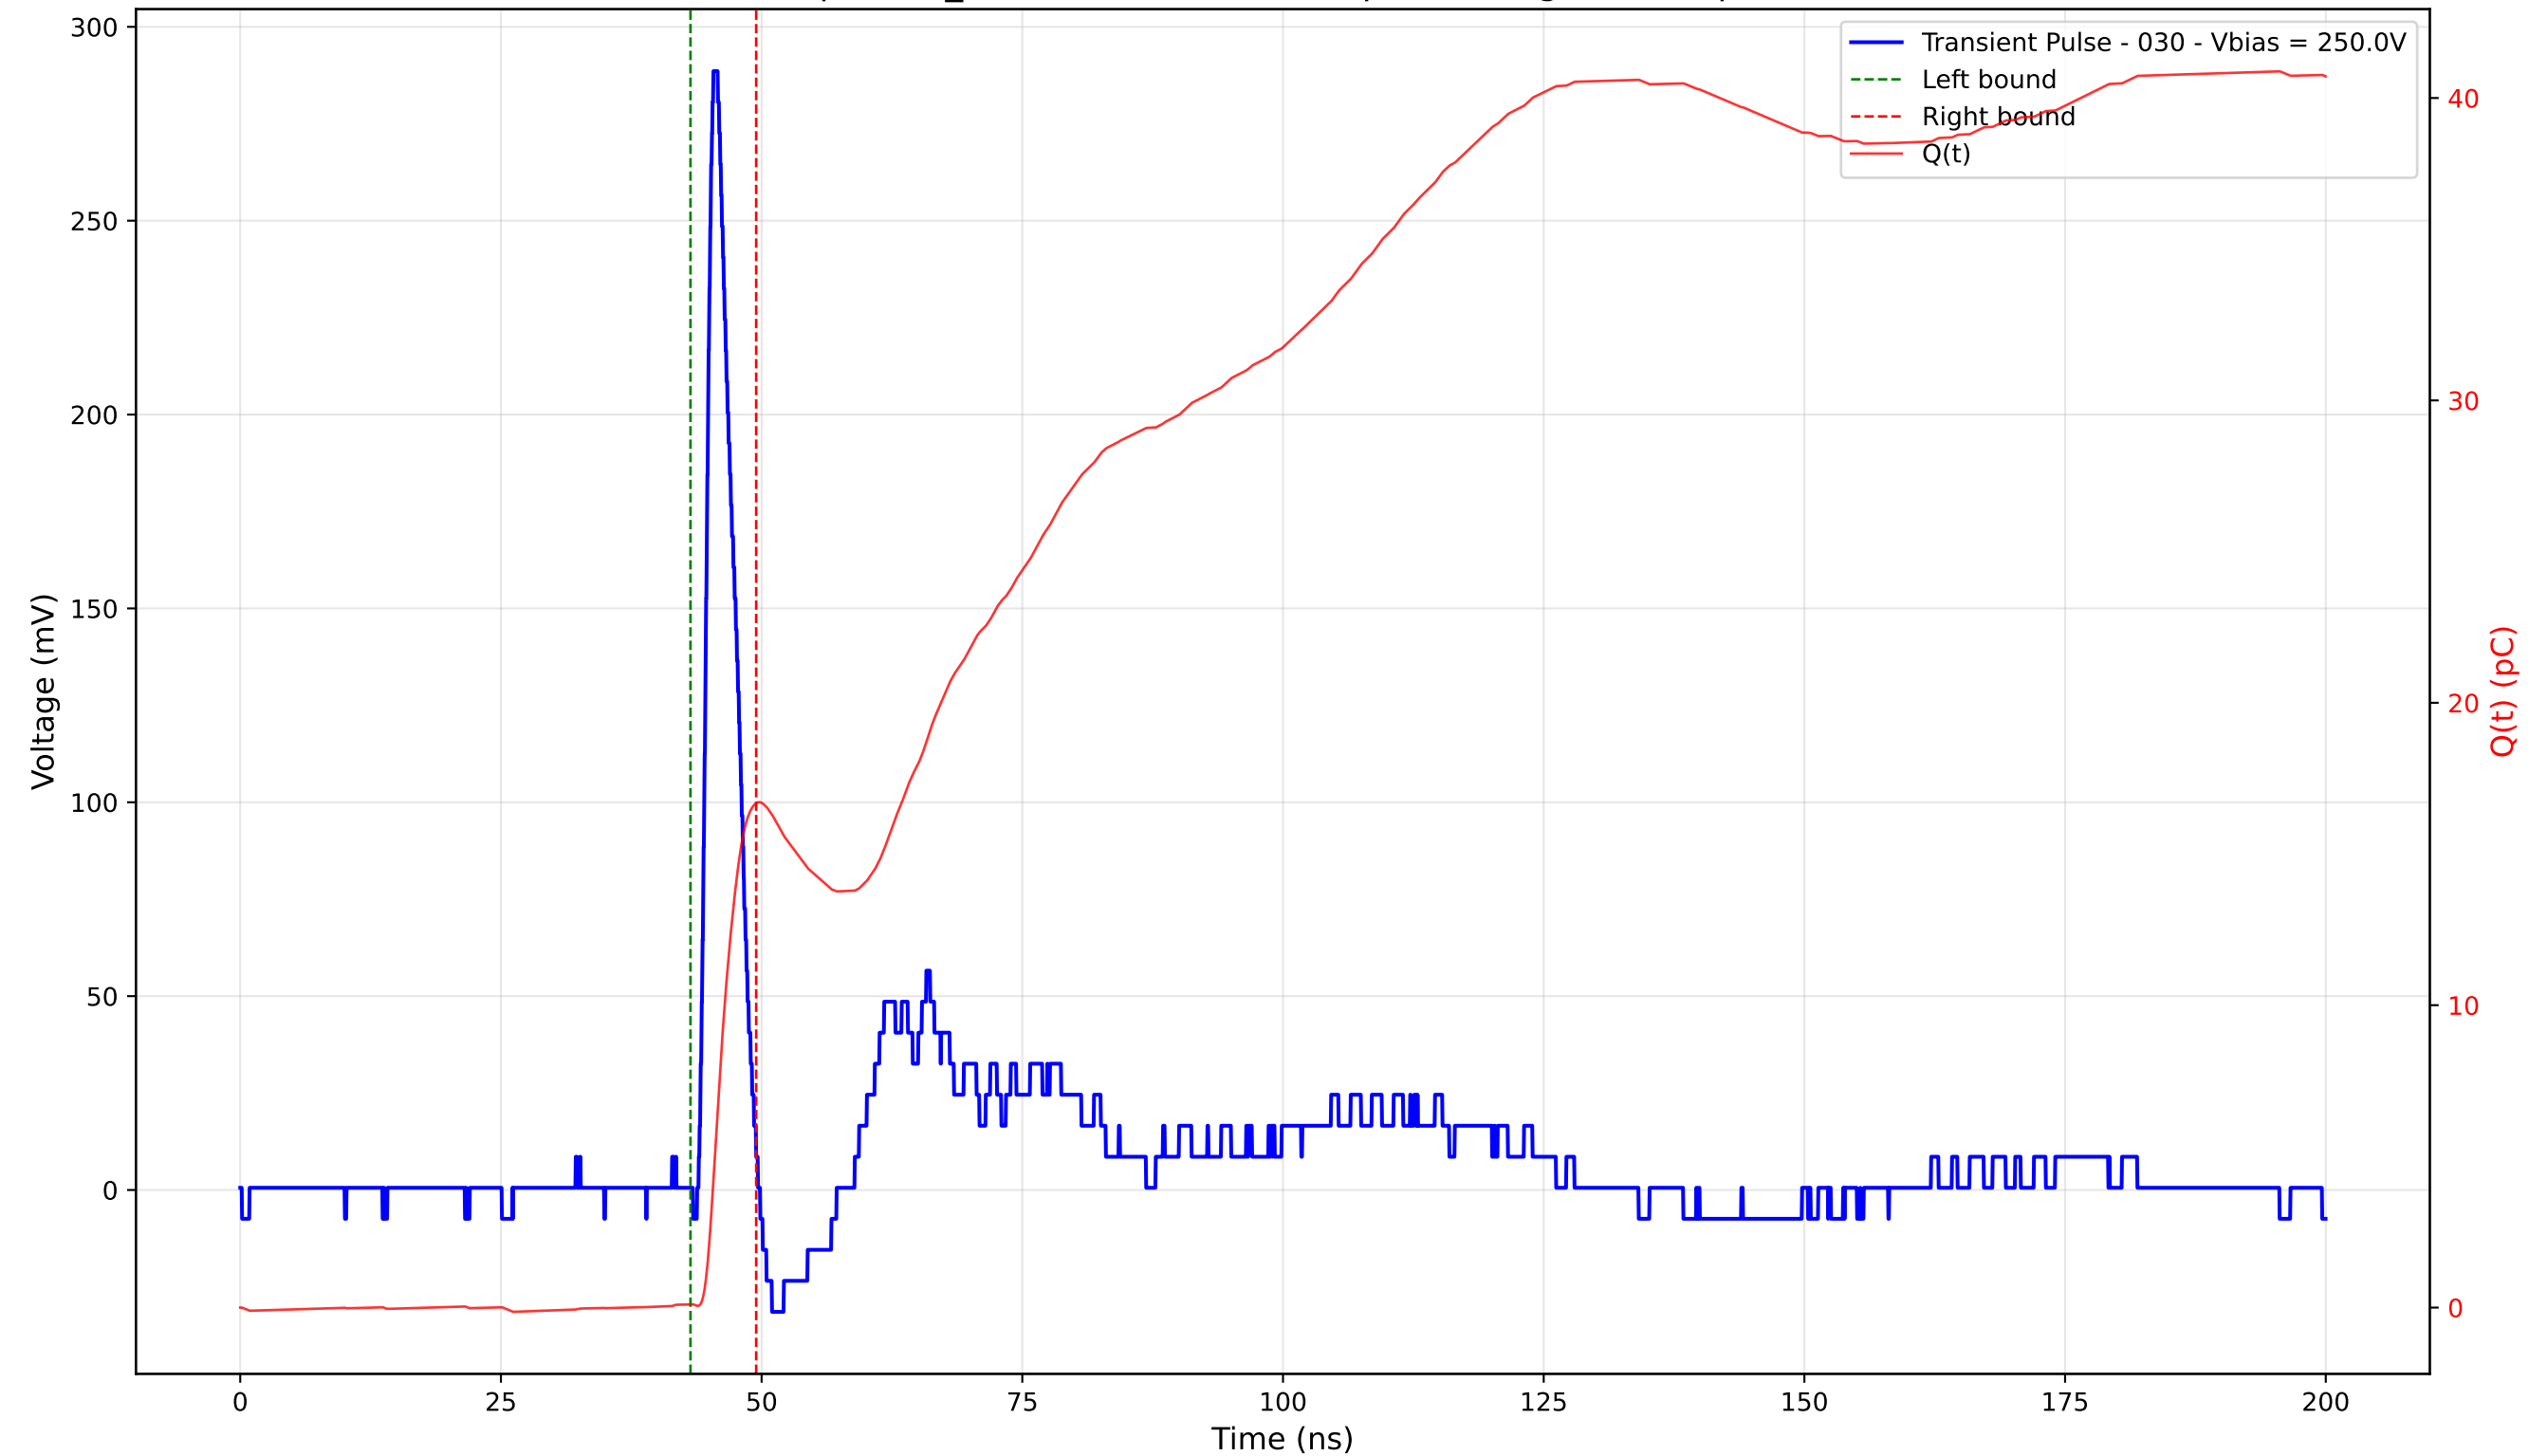


Transient Pulse - Sample: TD_4004 - Position: 405.0 μm - Charge: 13.28 pC - Rise Time: 1.06 ns

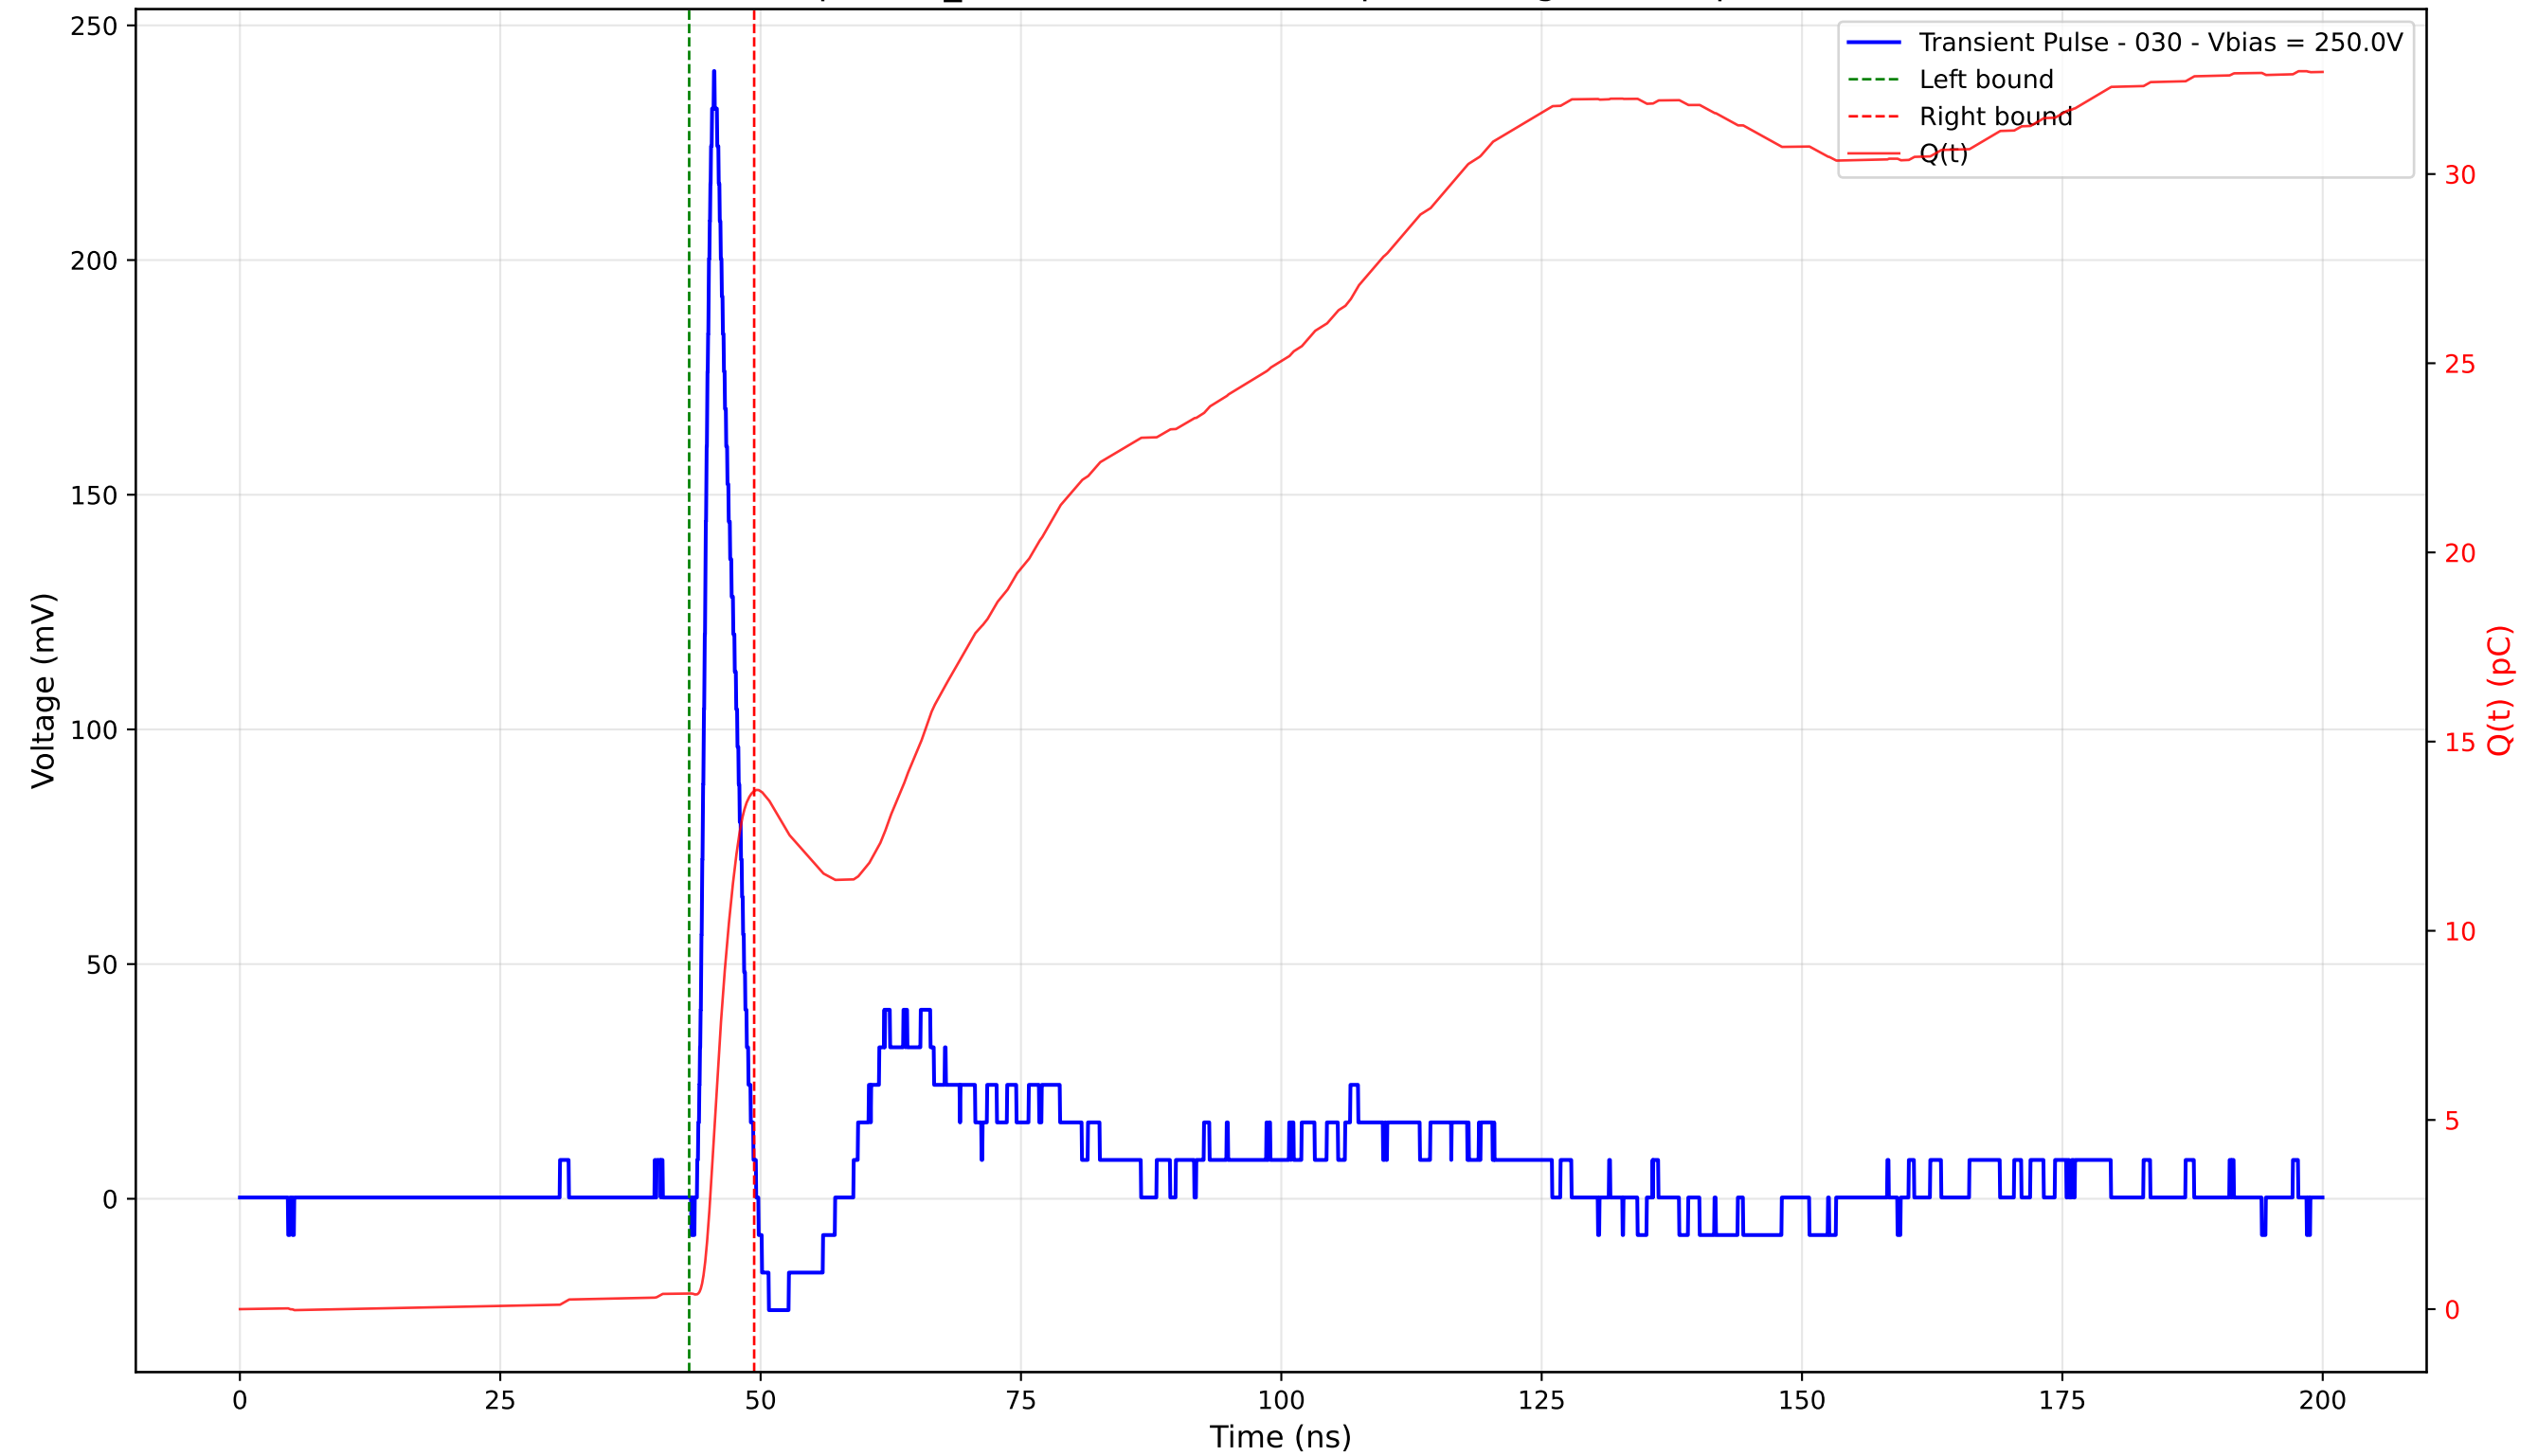


Transient Pulse - Sample: TD_4004 - Position: 410.0 μm - Charge: 10.64 pC - Rise Time: 1.09 ns

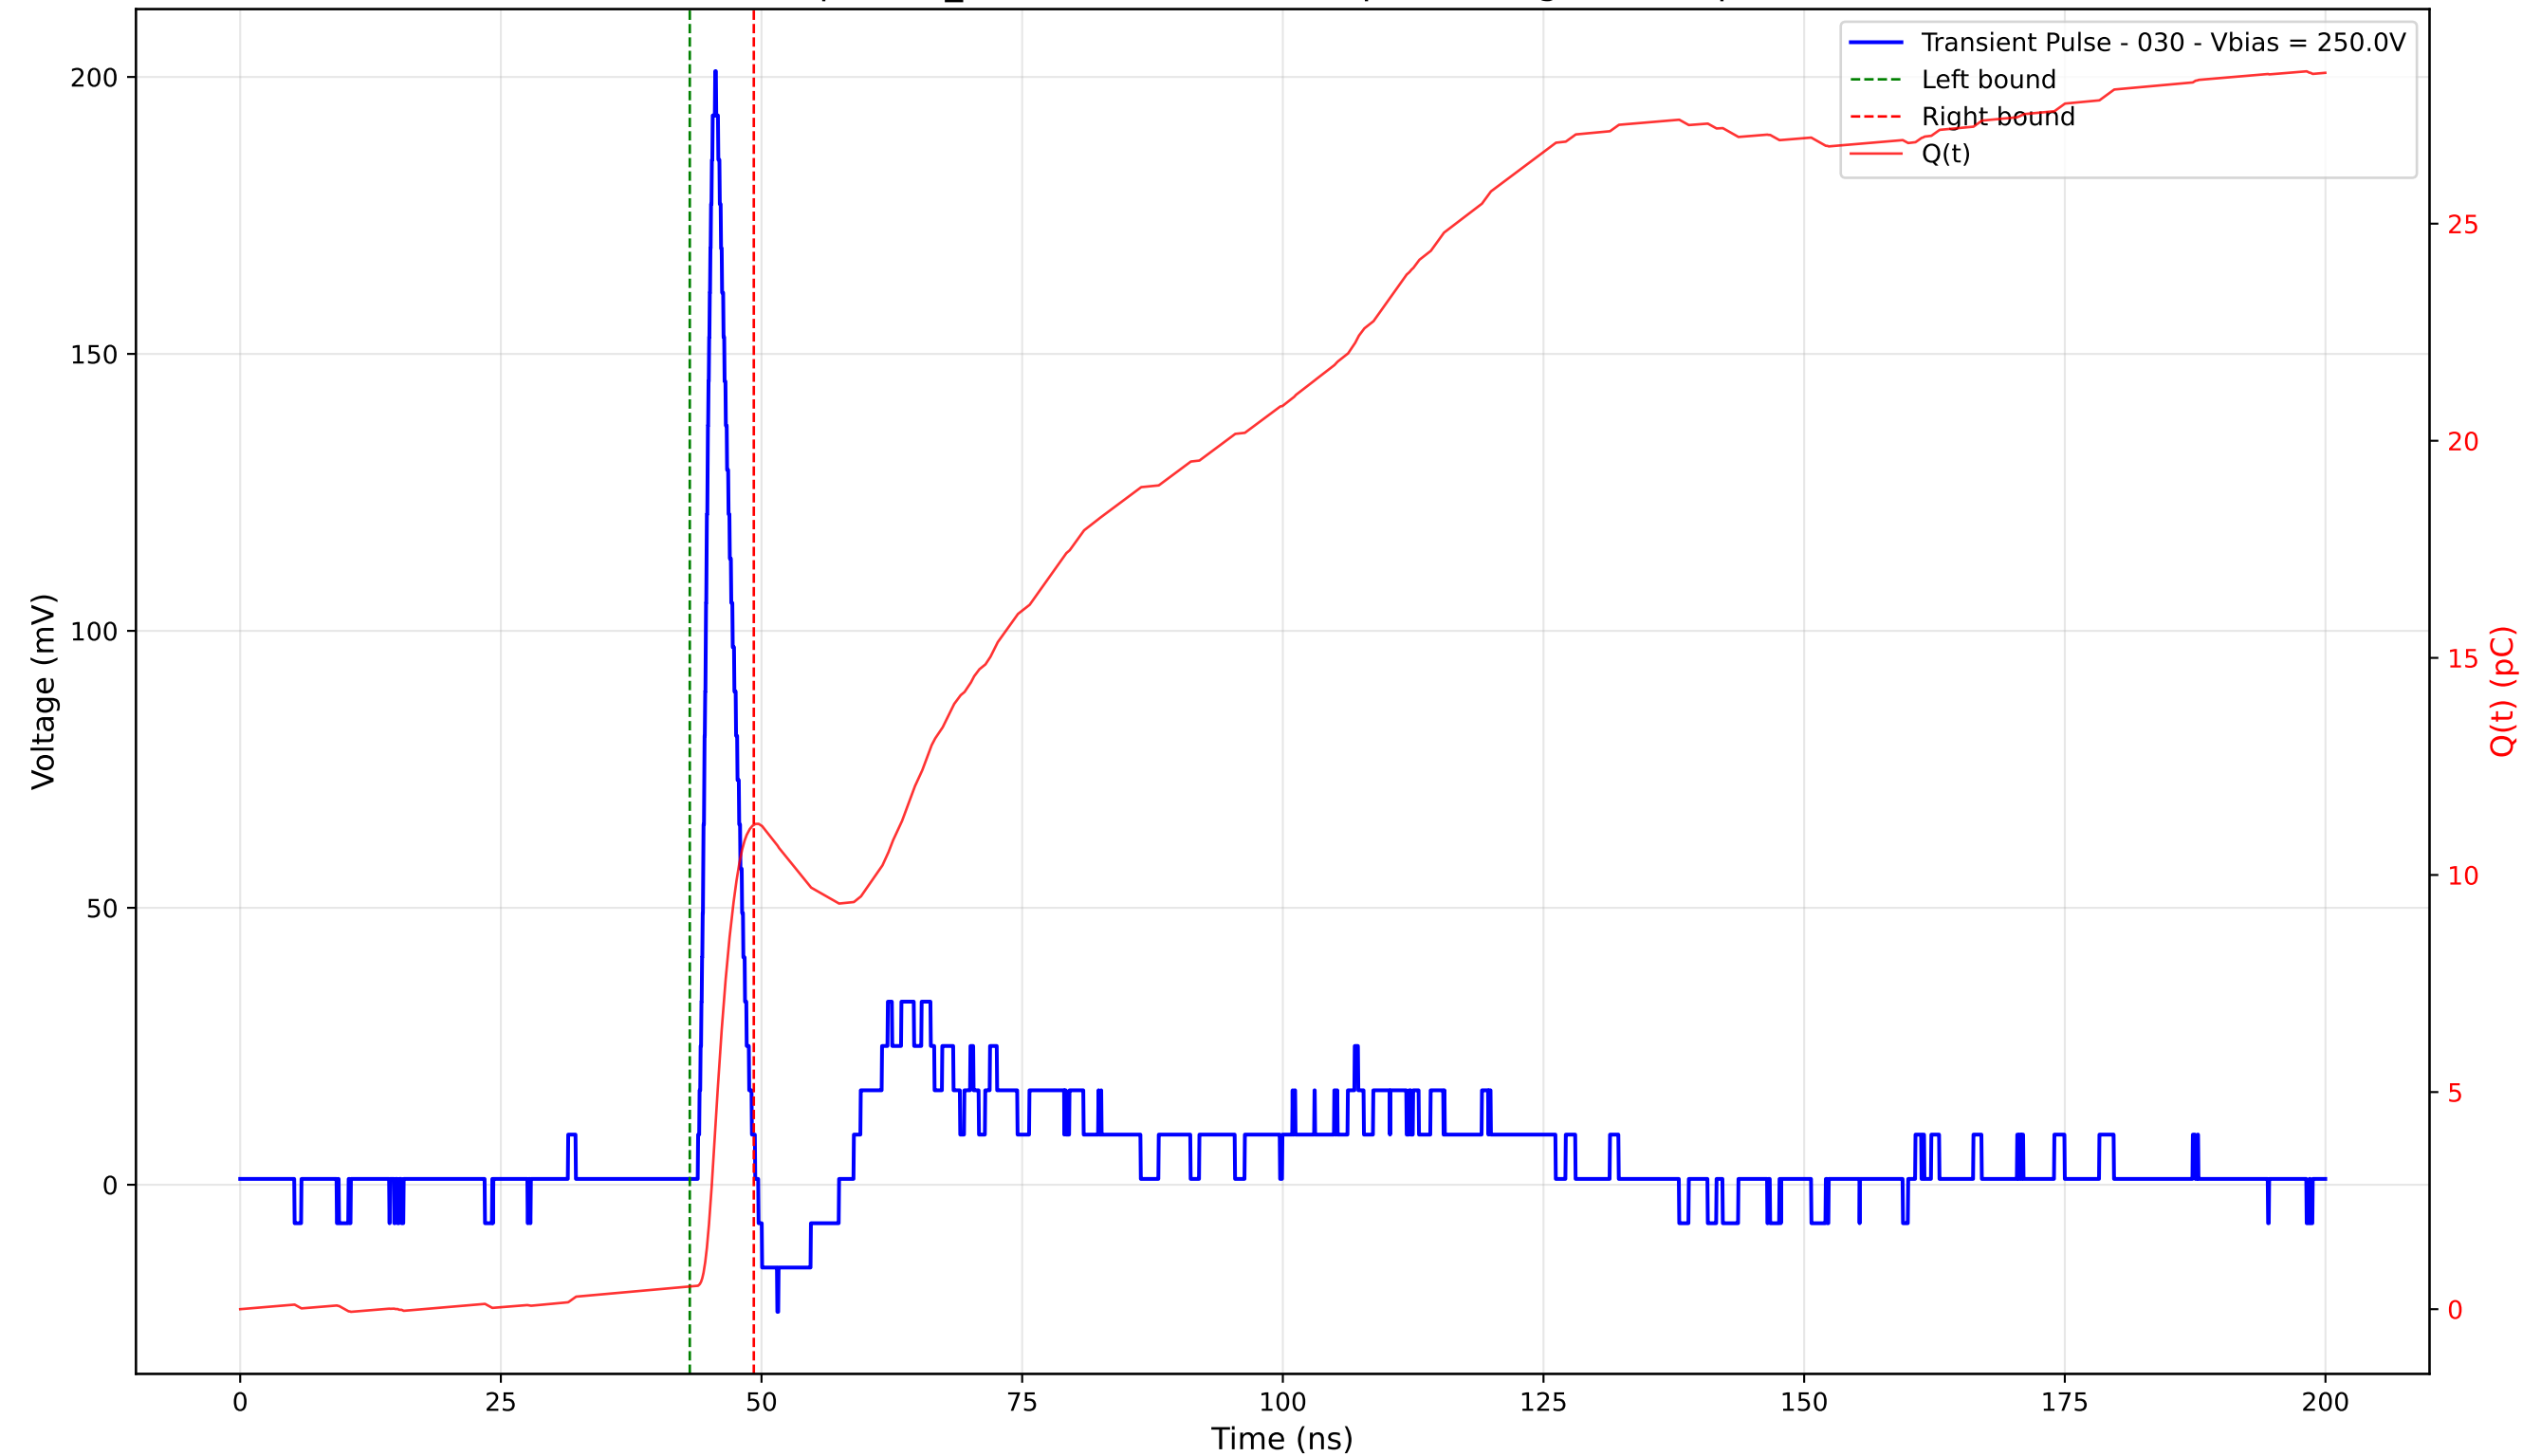


Transient Pulse - Sample: TD_4004 - Position: 415.0 μm - Charge: 7.35 pC - Rise Time: 1.10 ns

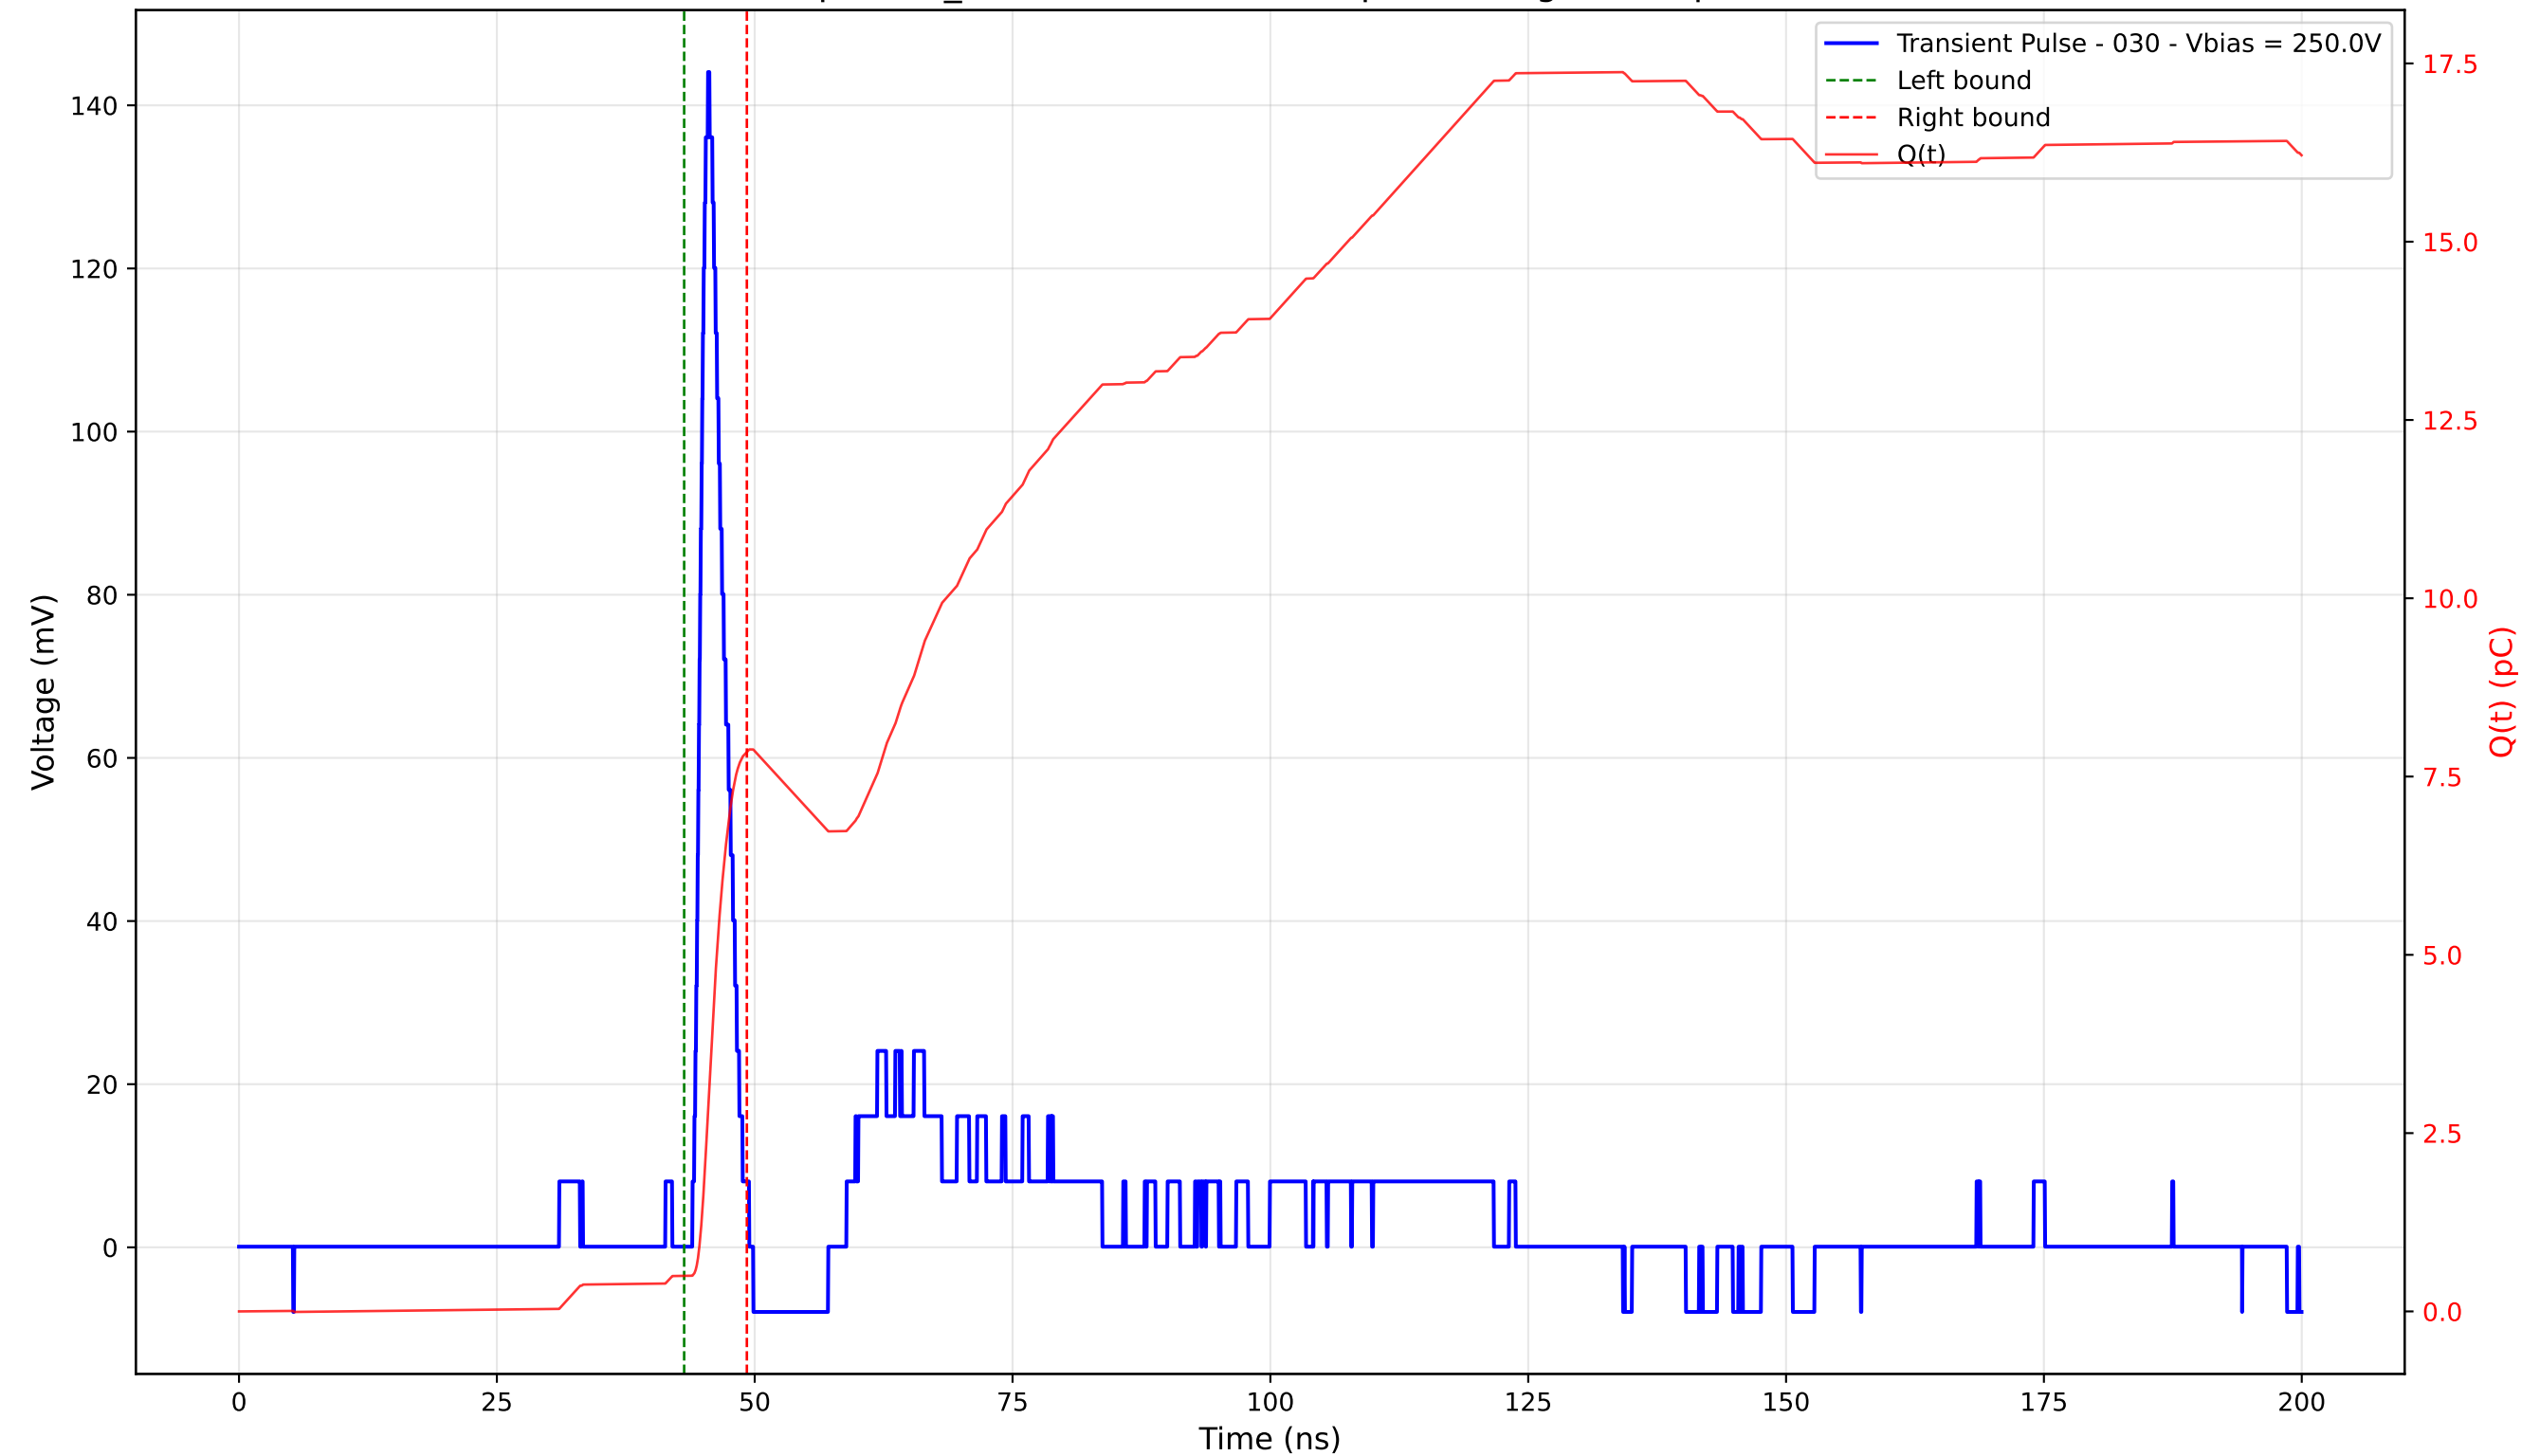


Transient Pulse - Sample: TD_4004 - Position: 420.0 μm - Charge: 4.71 pC - Rise Time: 0.86 ns

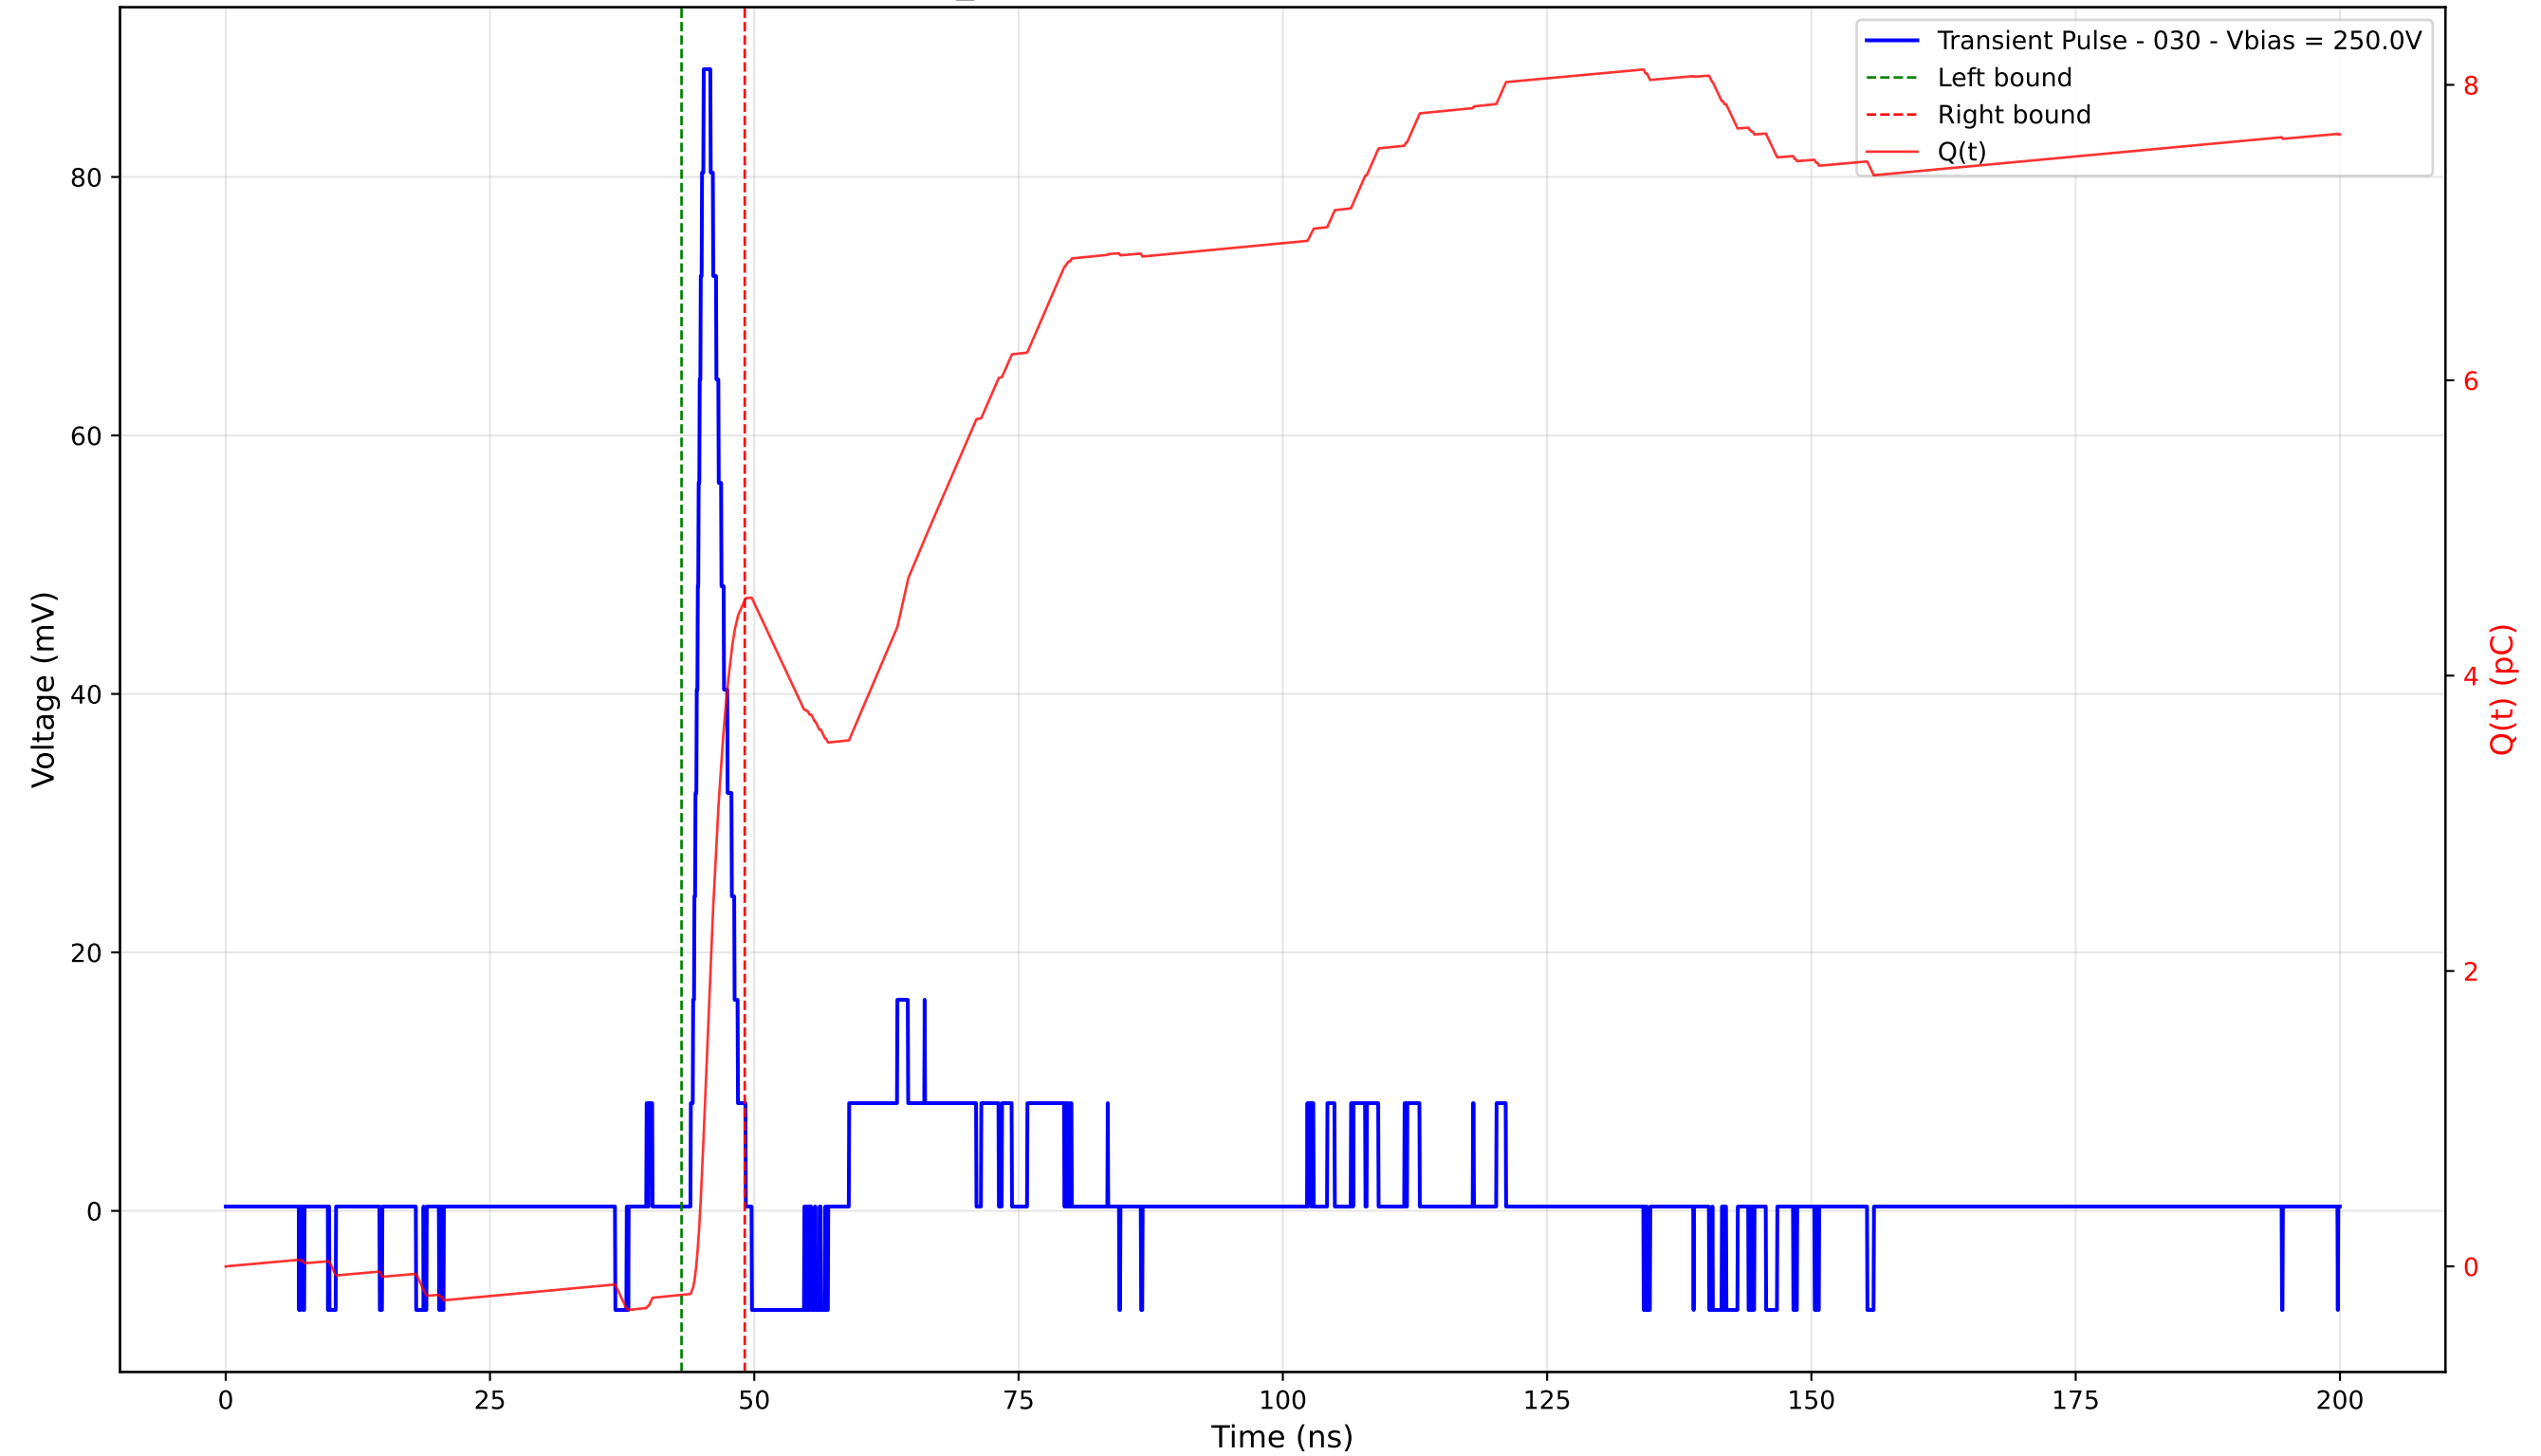

Transient Pulse - Sample: TD_4004 - Position: 425.0 μm - Charge: 3.56 pC - Rise Time: 1.47 ns

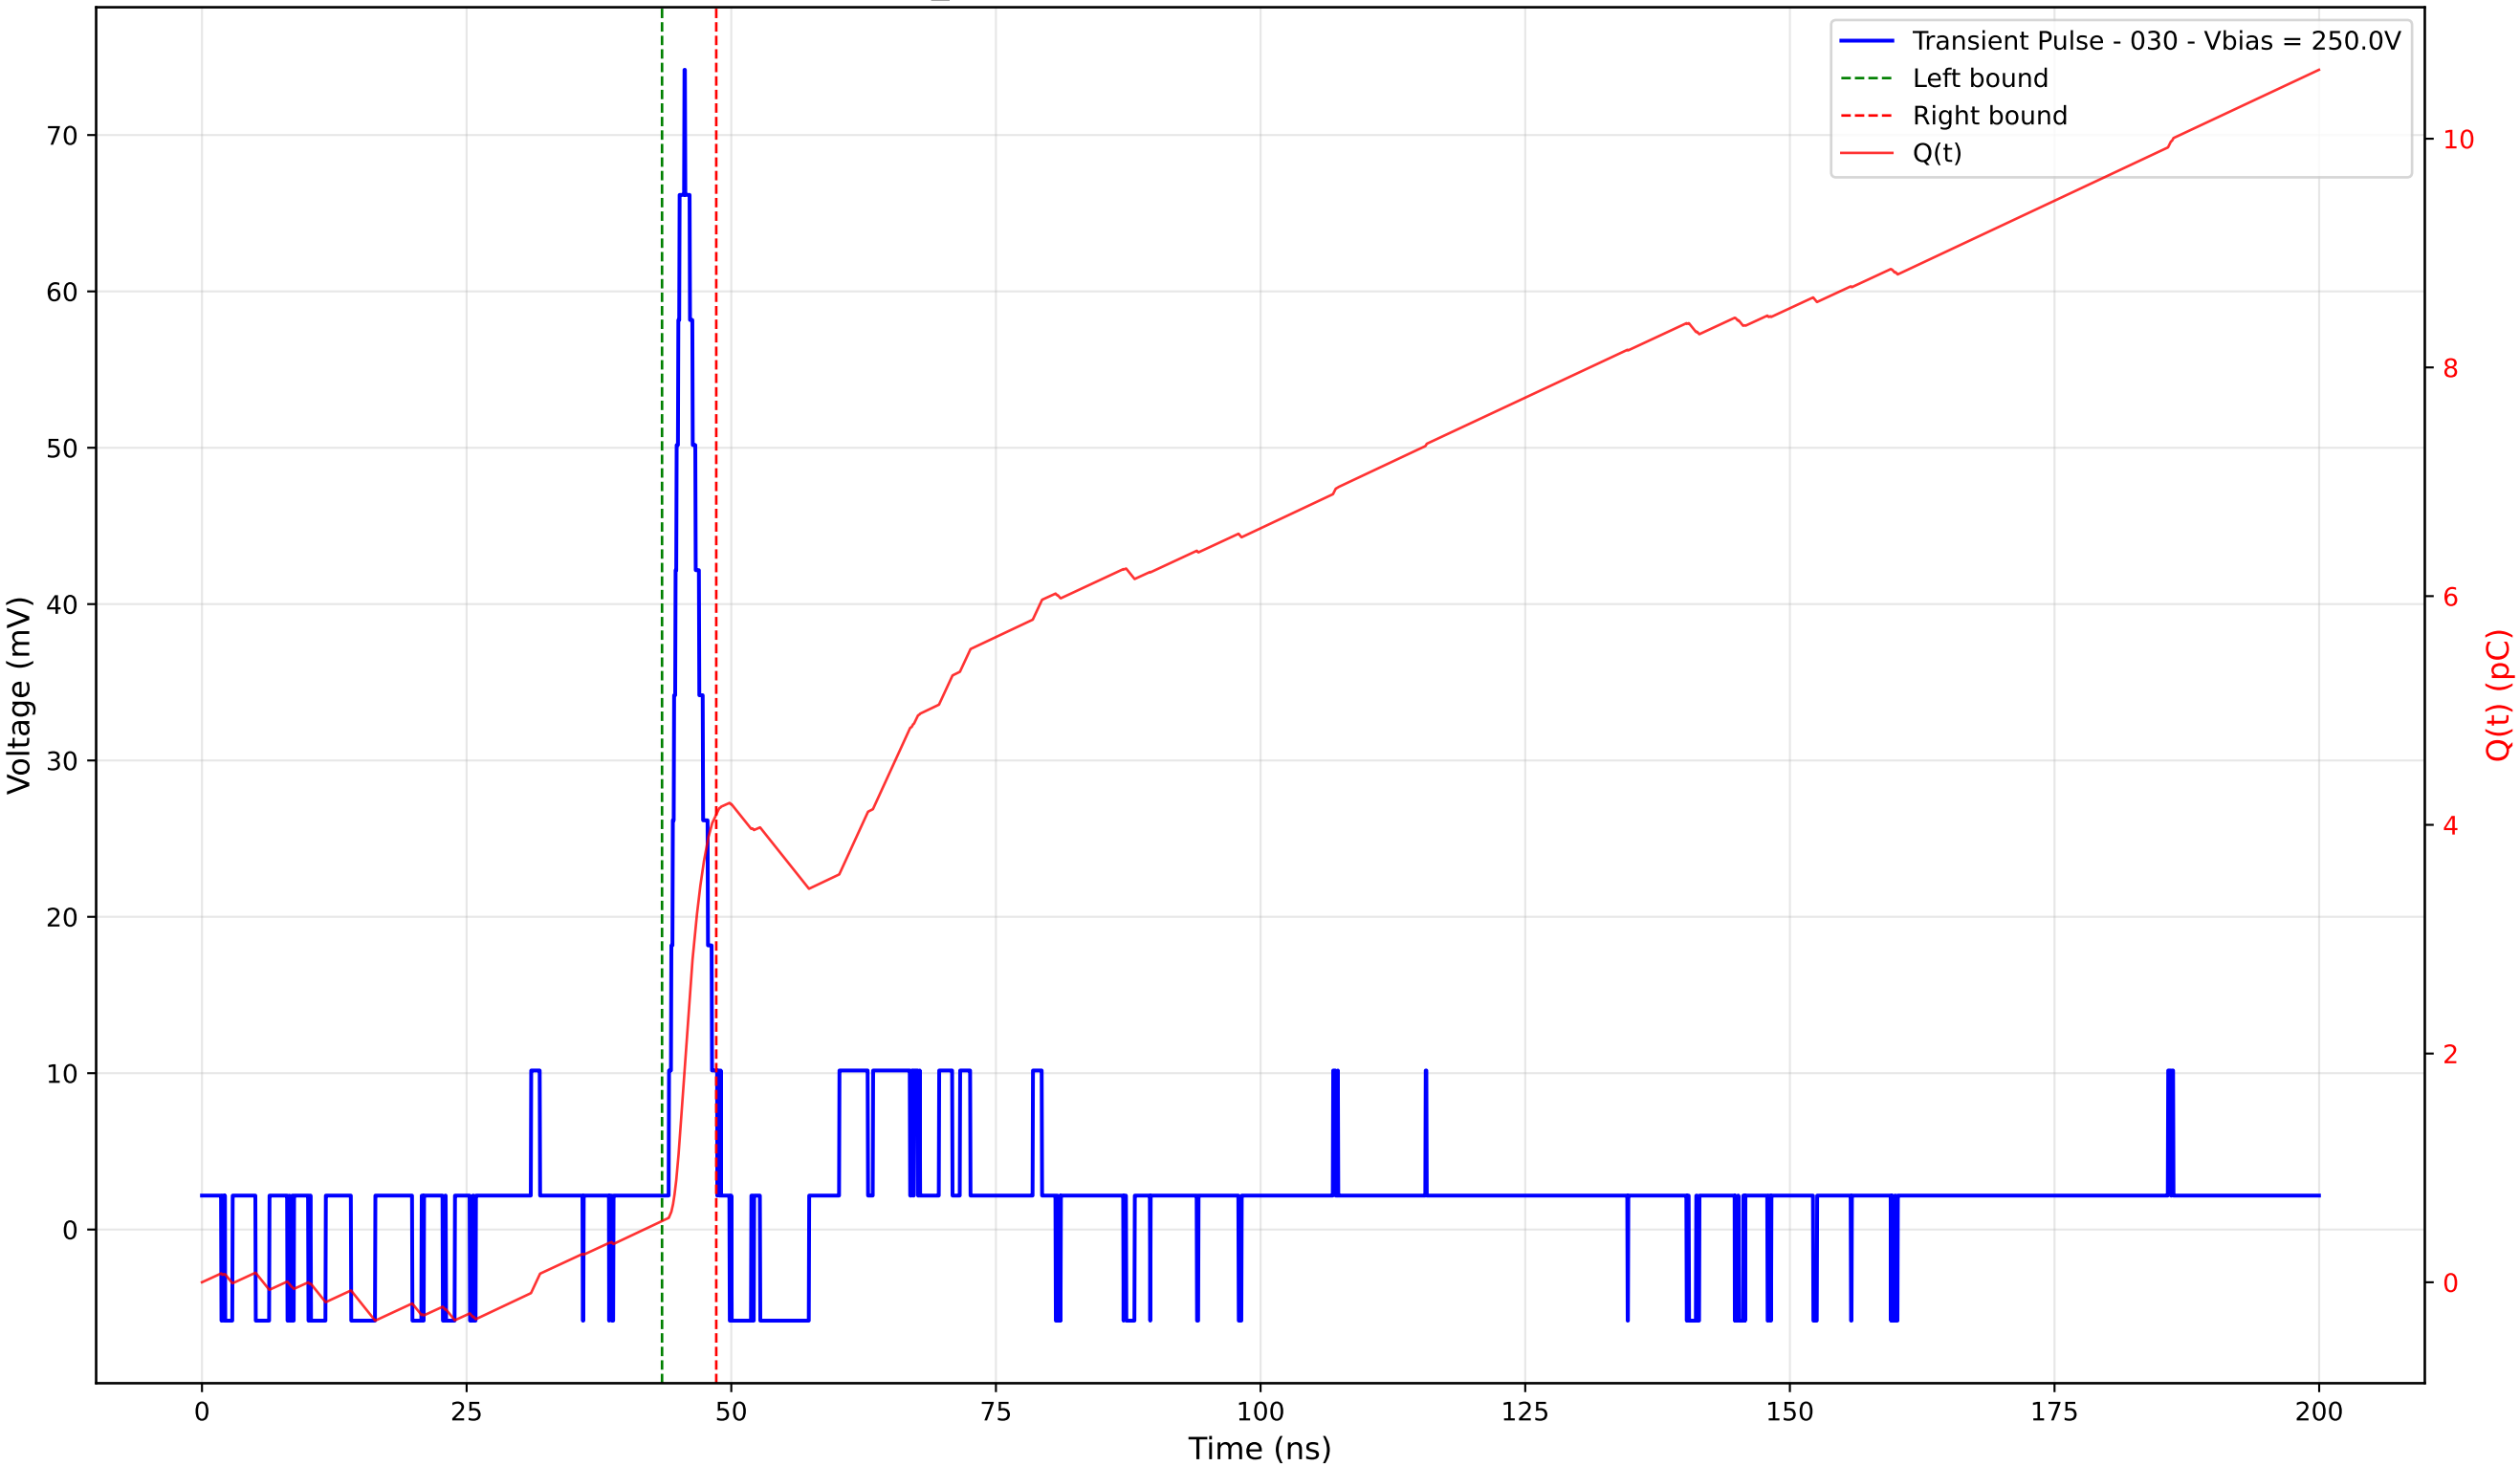

Transient Pulse - Sample: TD_4004 - Position: 430.0 μm - Charge: 3.33 pC - Rise Time: 0.94 ns

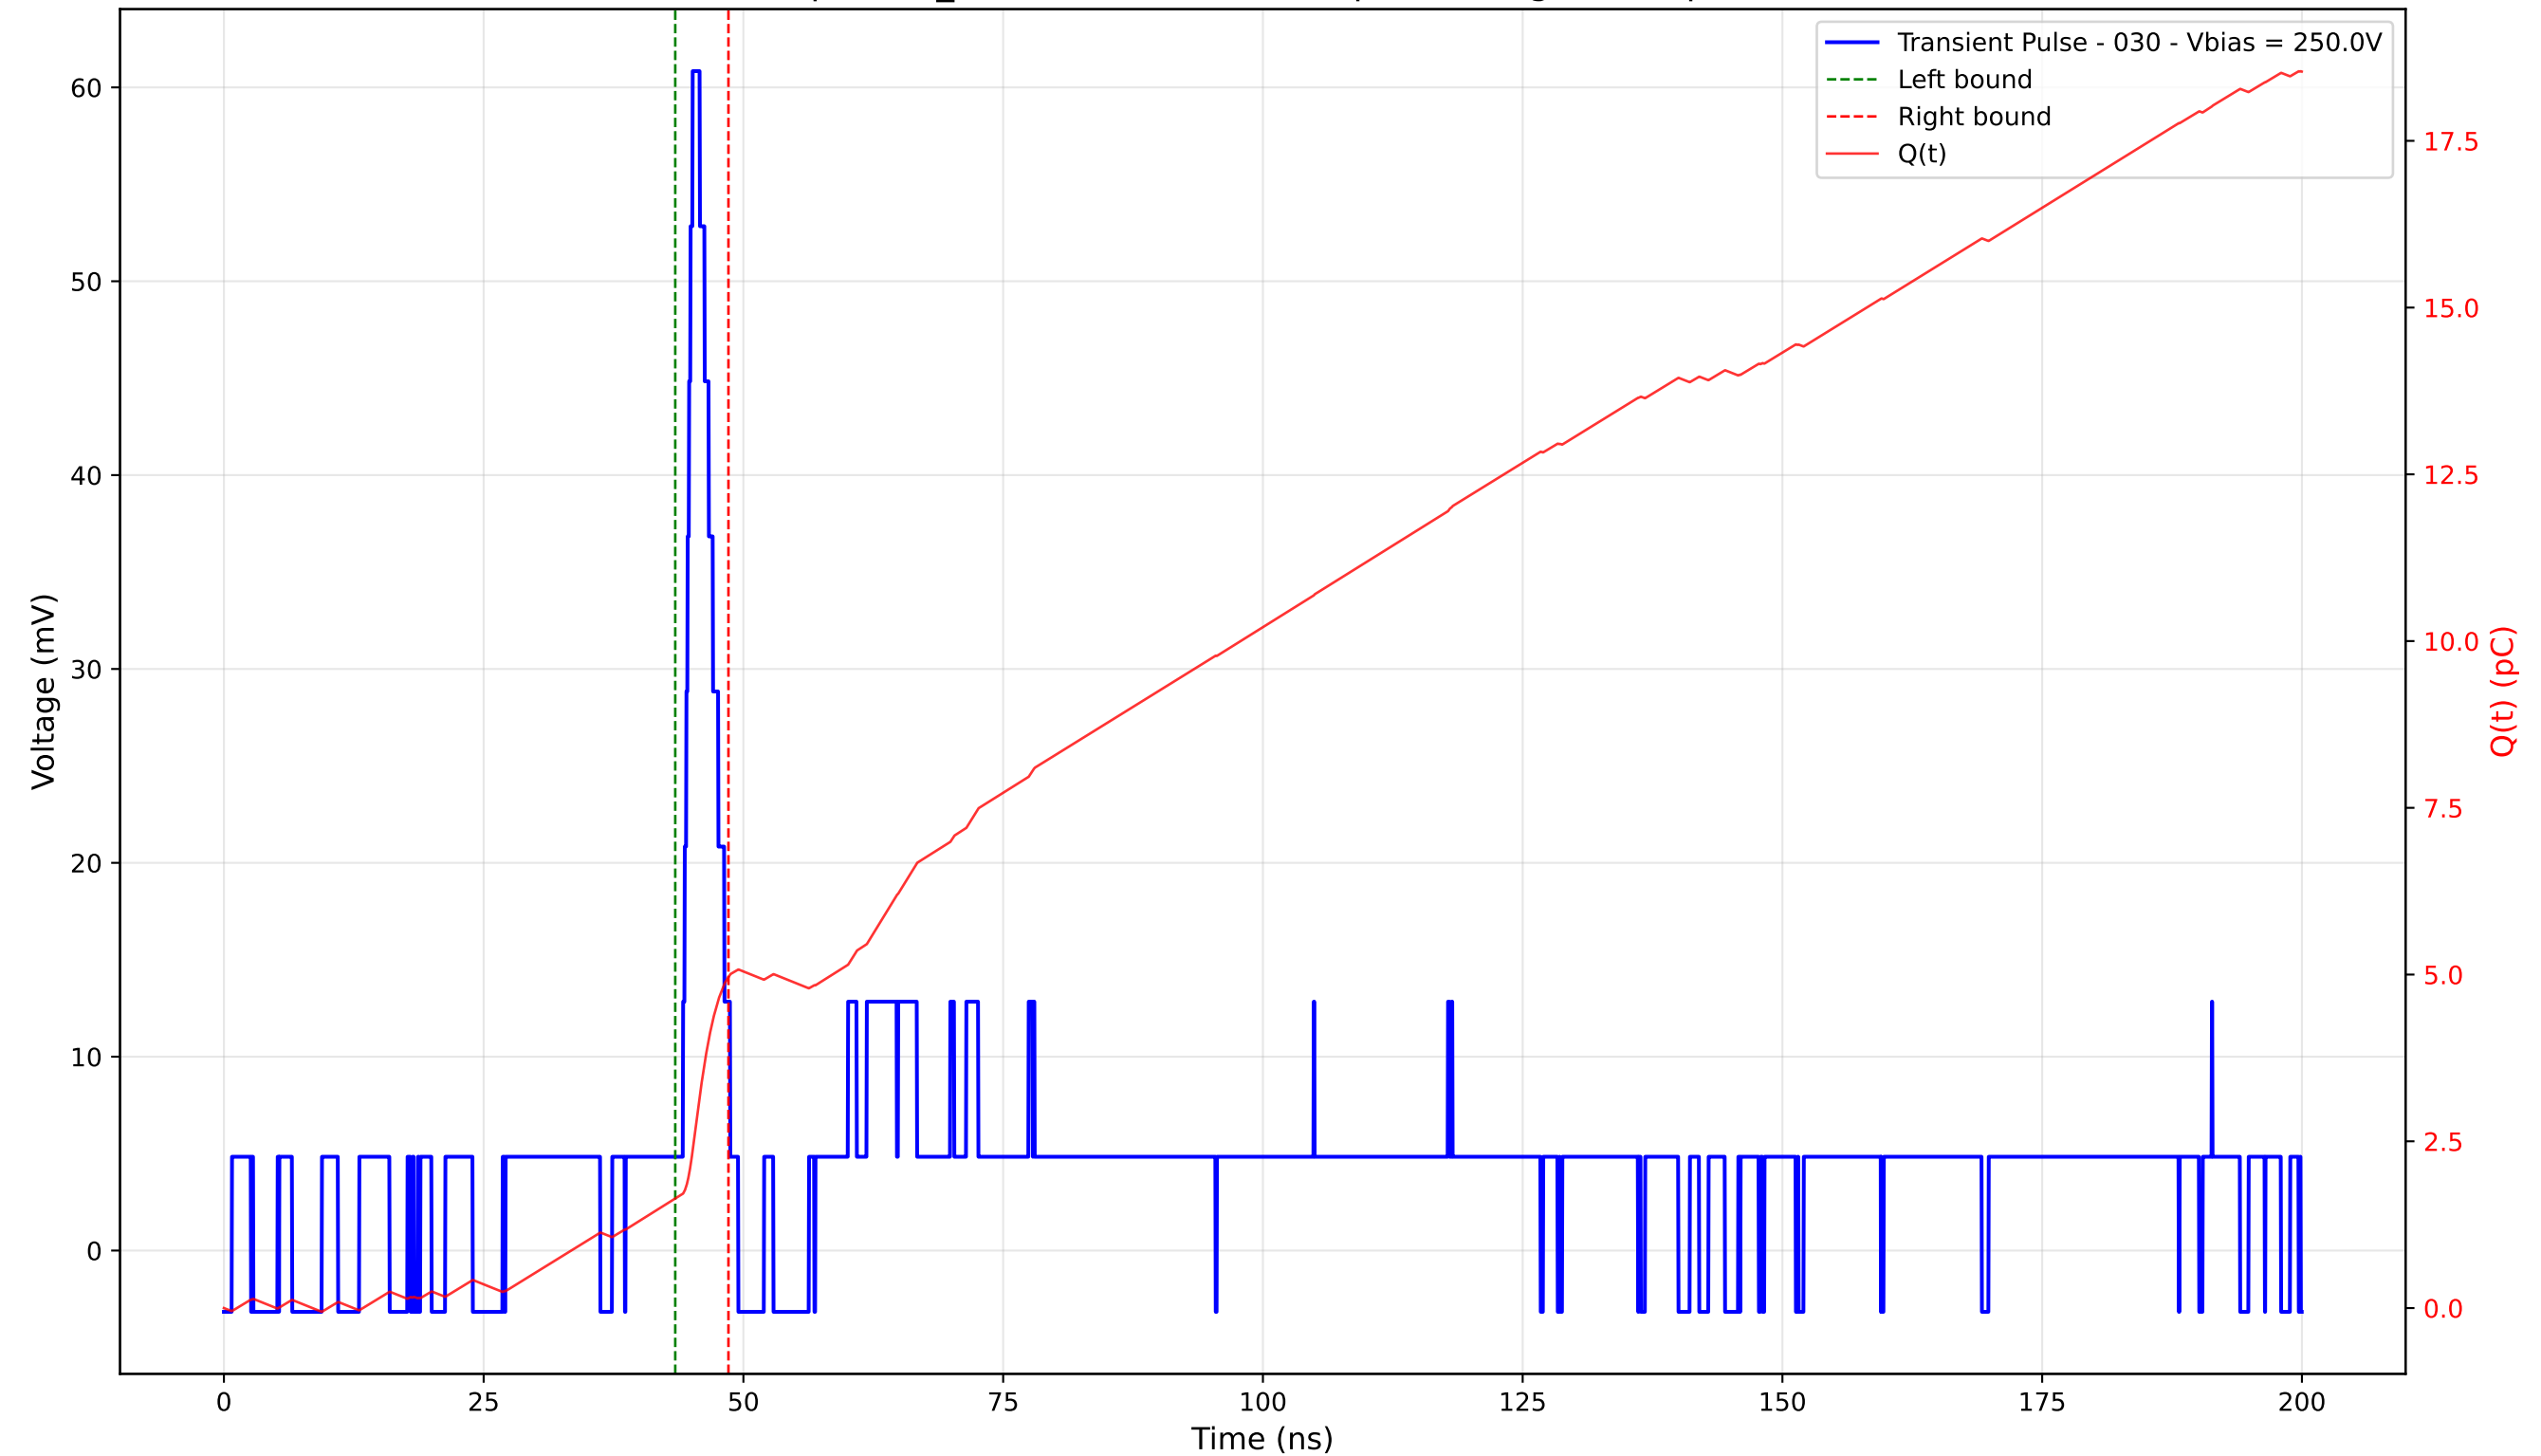

Transient Pulse - Sample: TD_4004 - Position: 435.0 μm - Charge: 3.20 pC - Rise Time: 1.10 ns

