


TCT Run 034 Summary

Parameter	Value
Run	Run034
Surface	N/A
Edge	x
Sample	TD_4004
Vbias (V)	150.0
DAC (%)	56.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\Run034
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

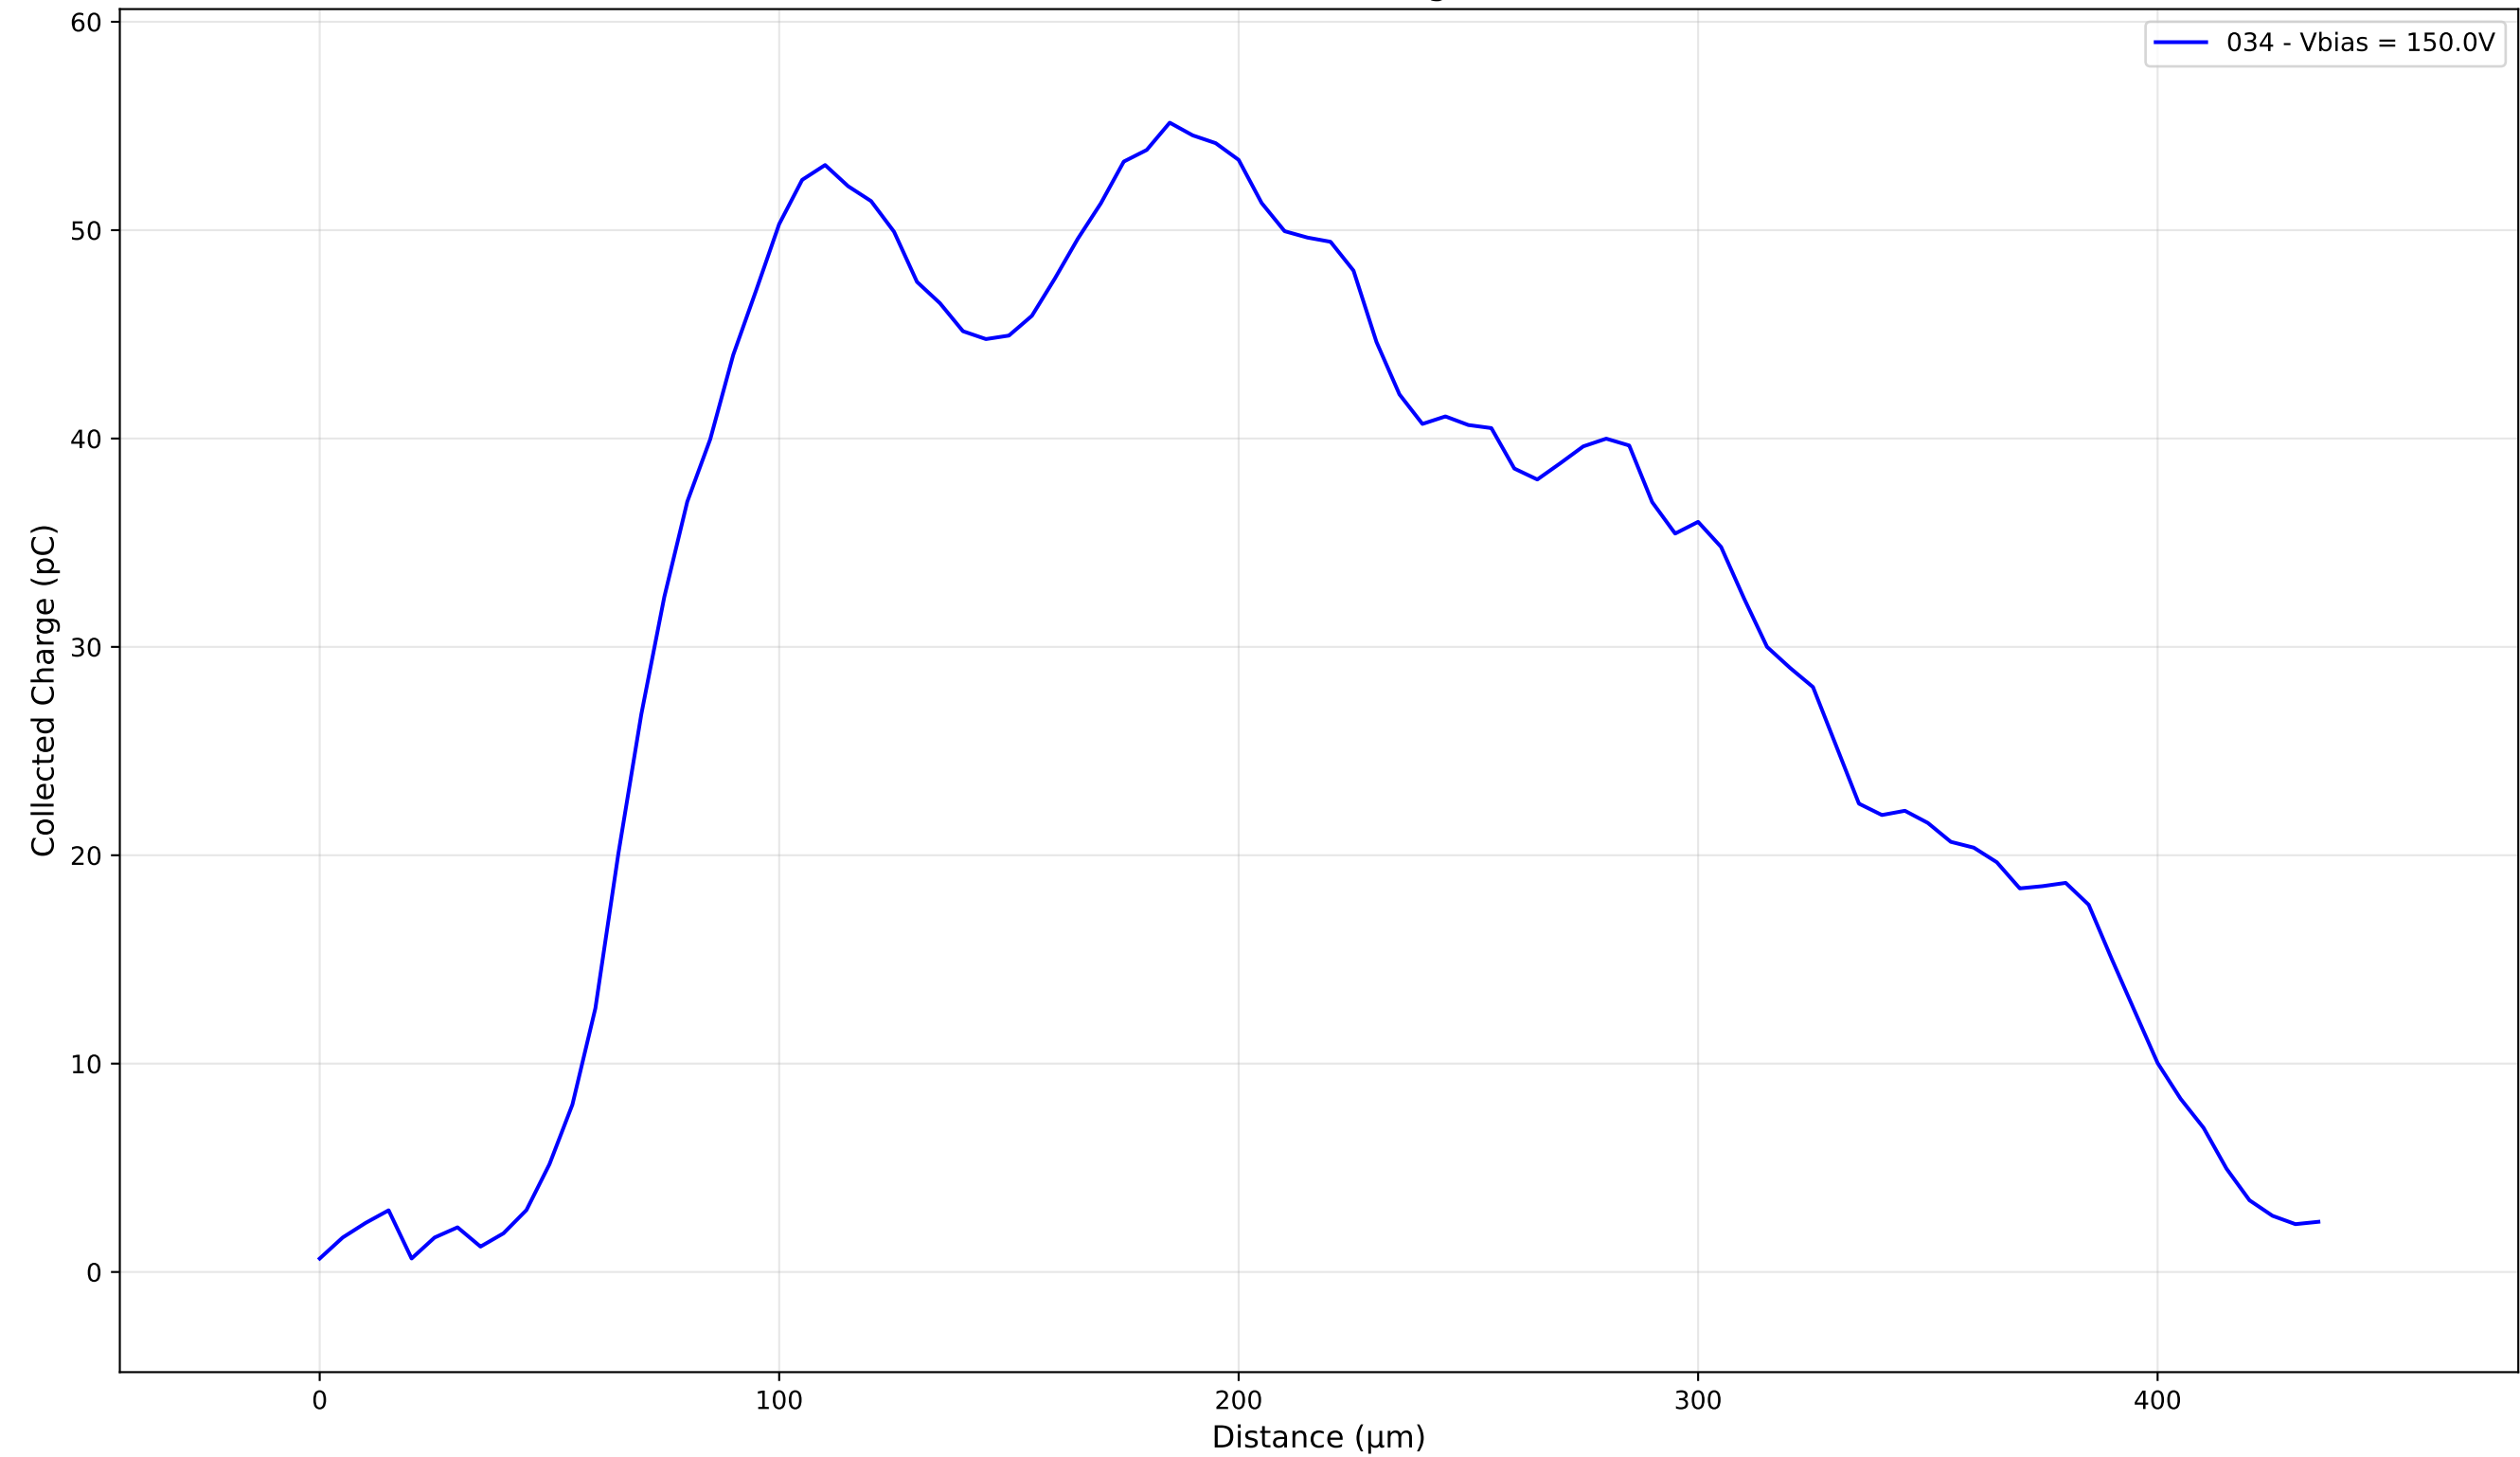

Collected Charge

034 - Vbias = 150.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

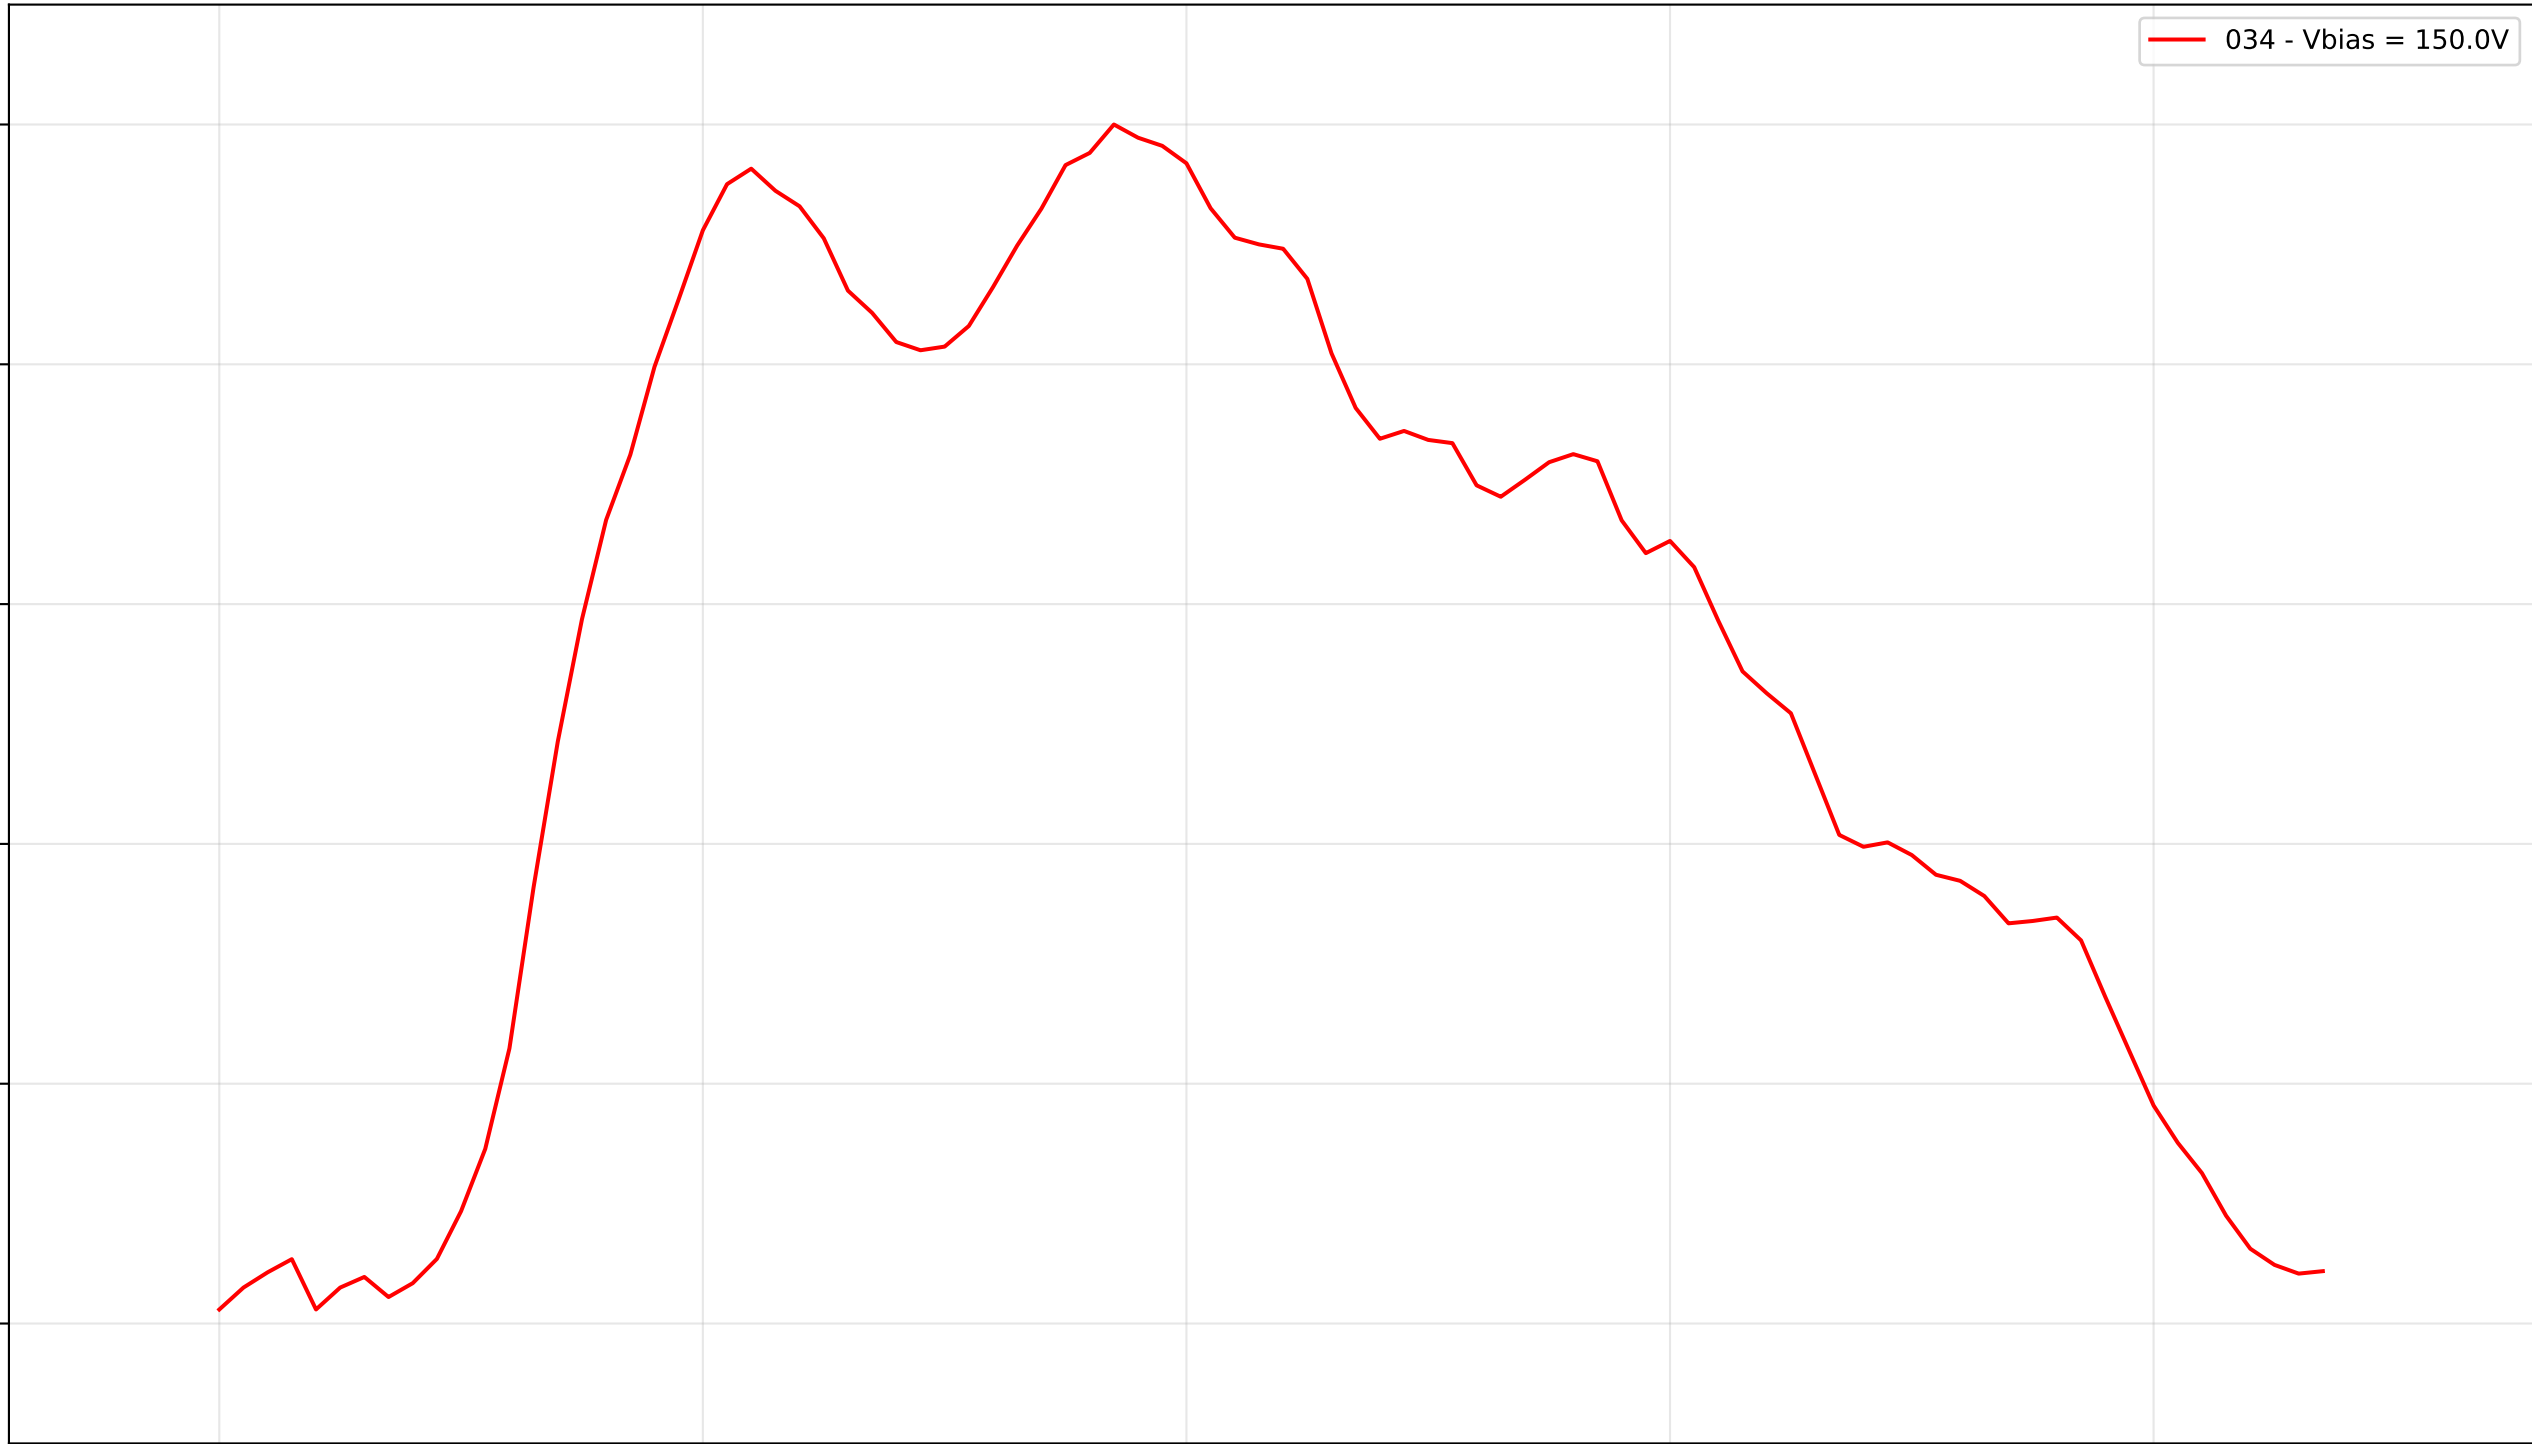


Rise Time

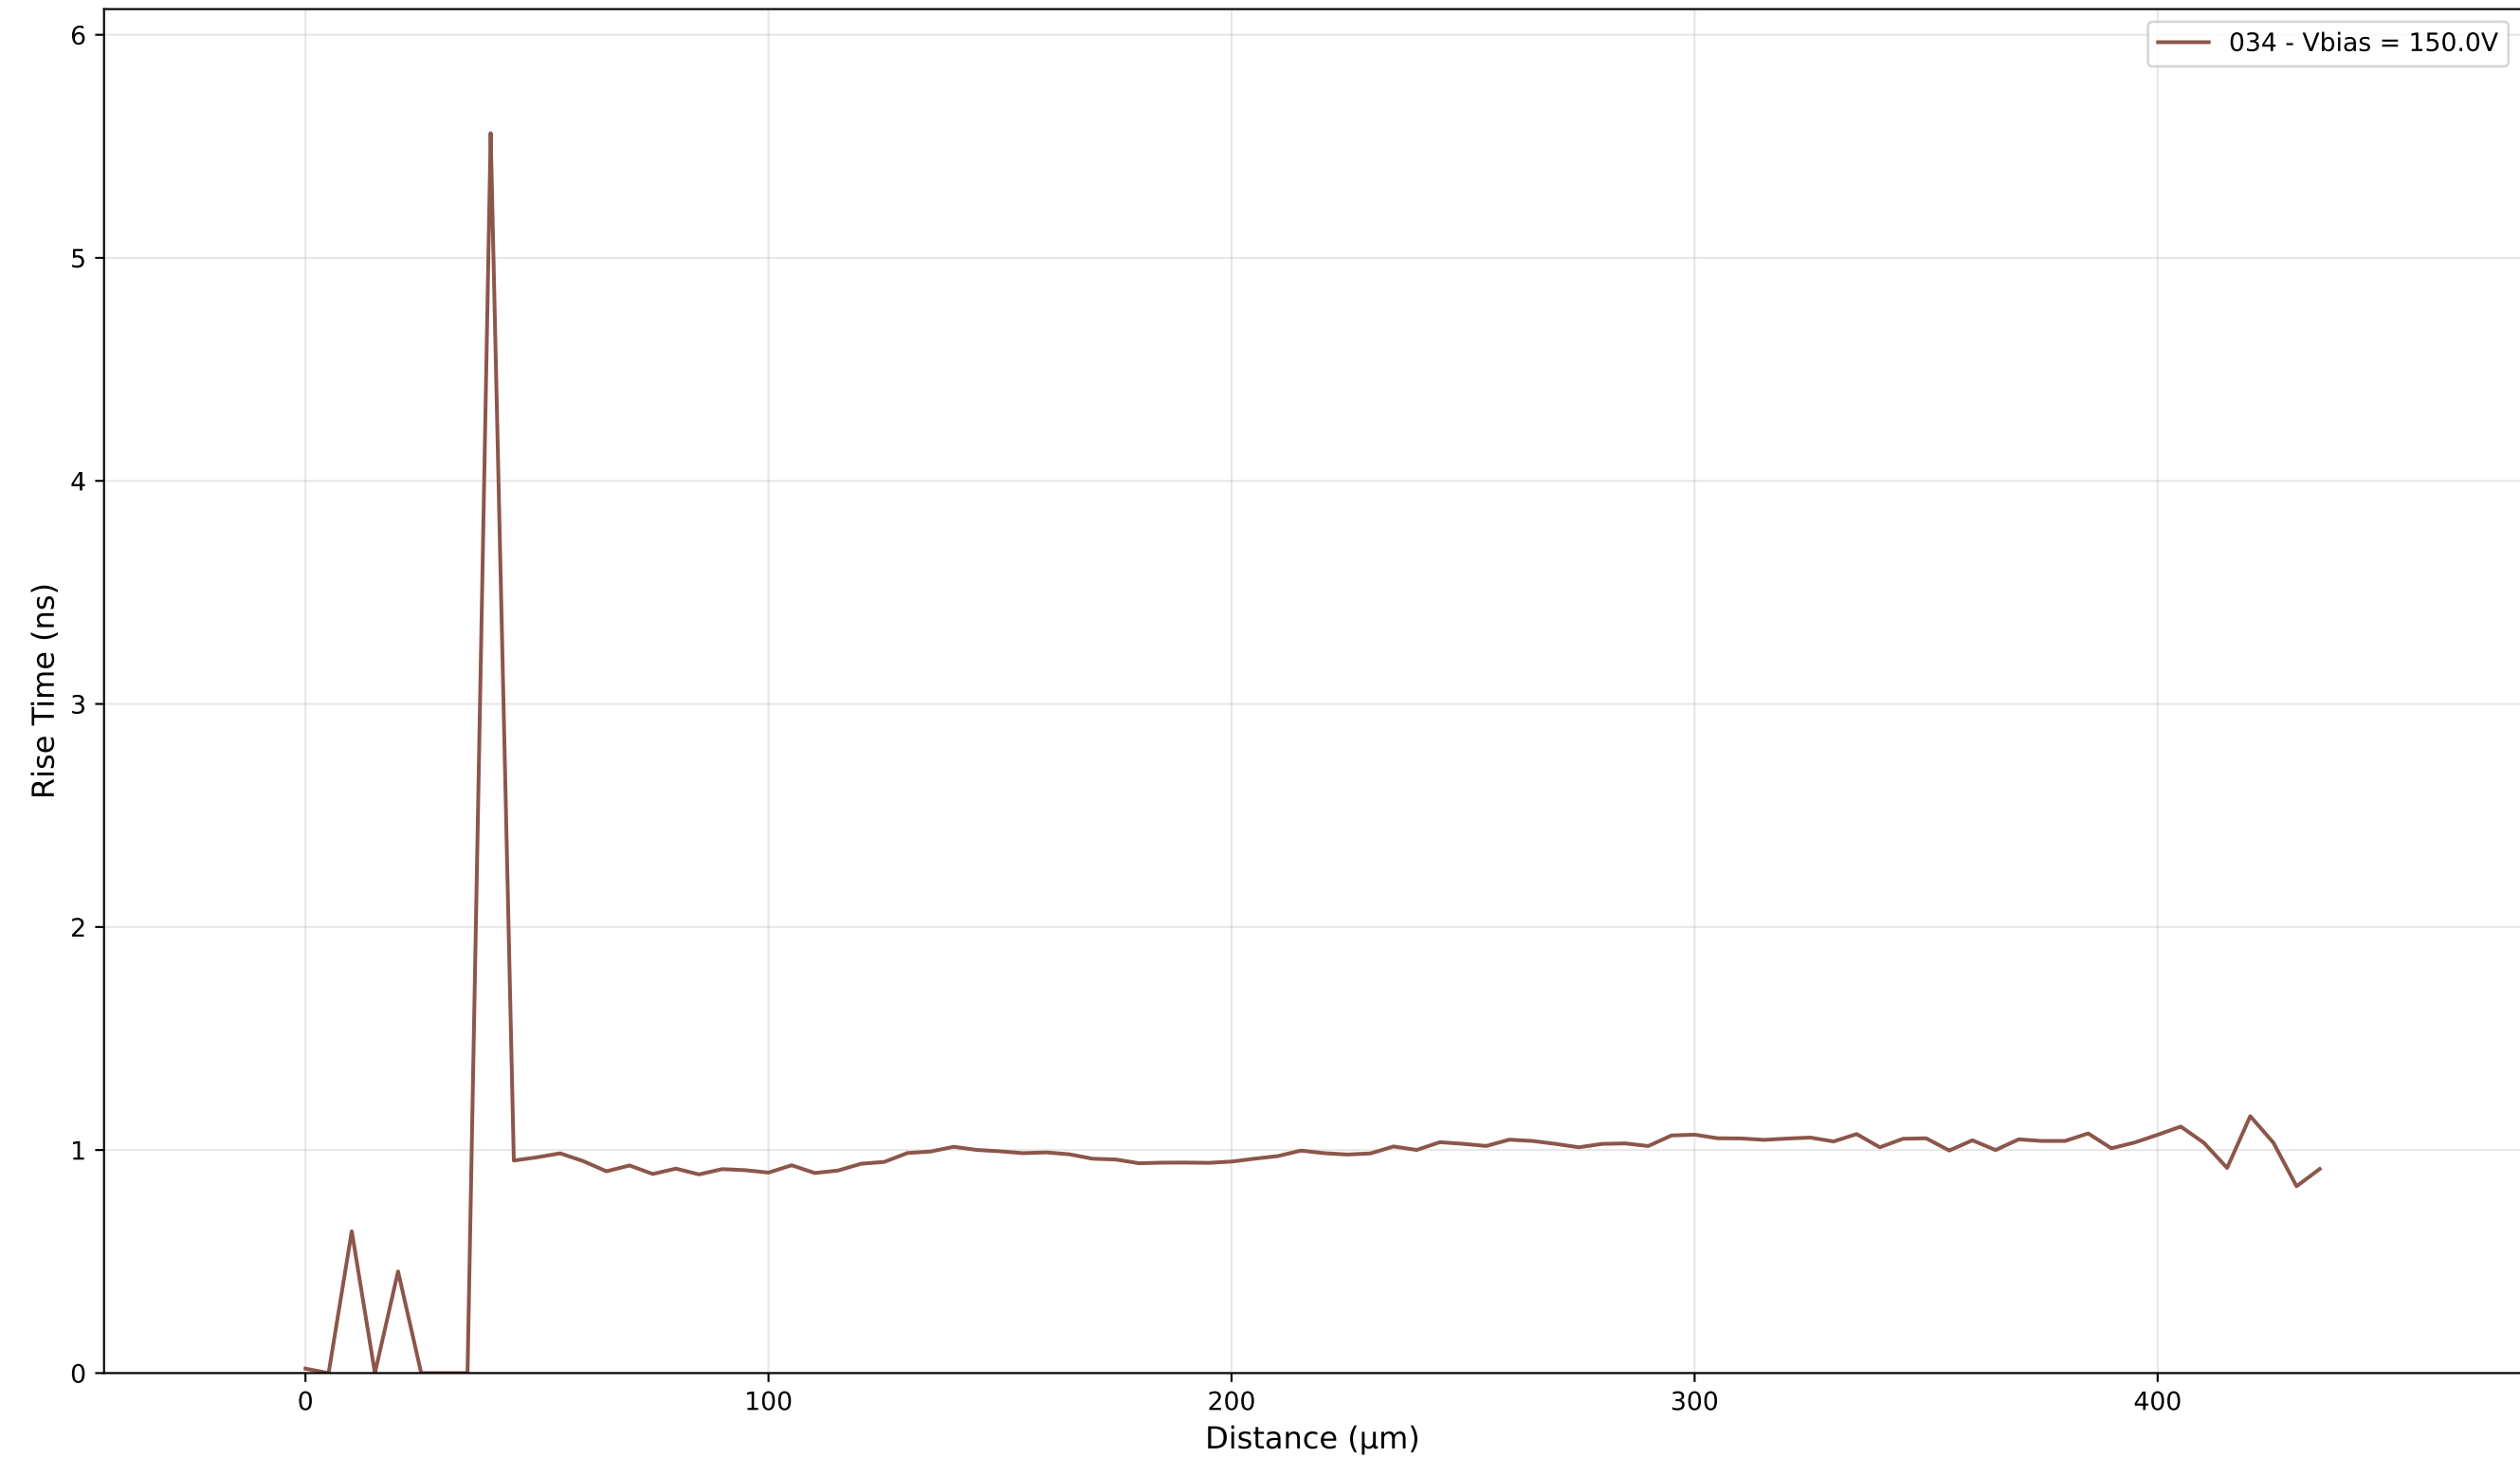


Amplitude

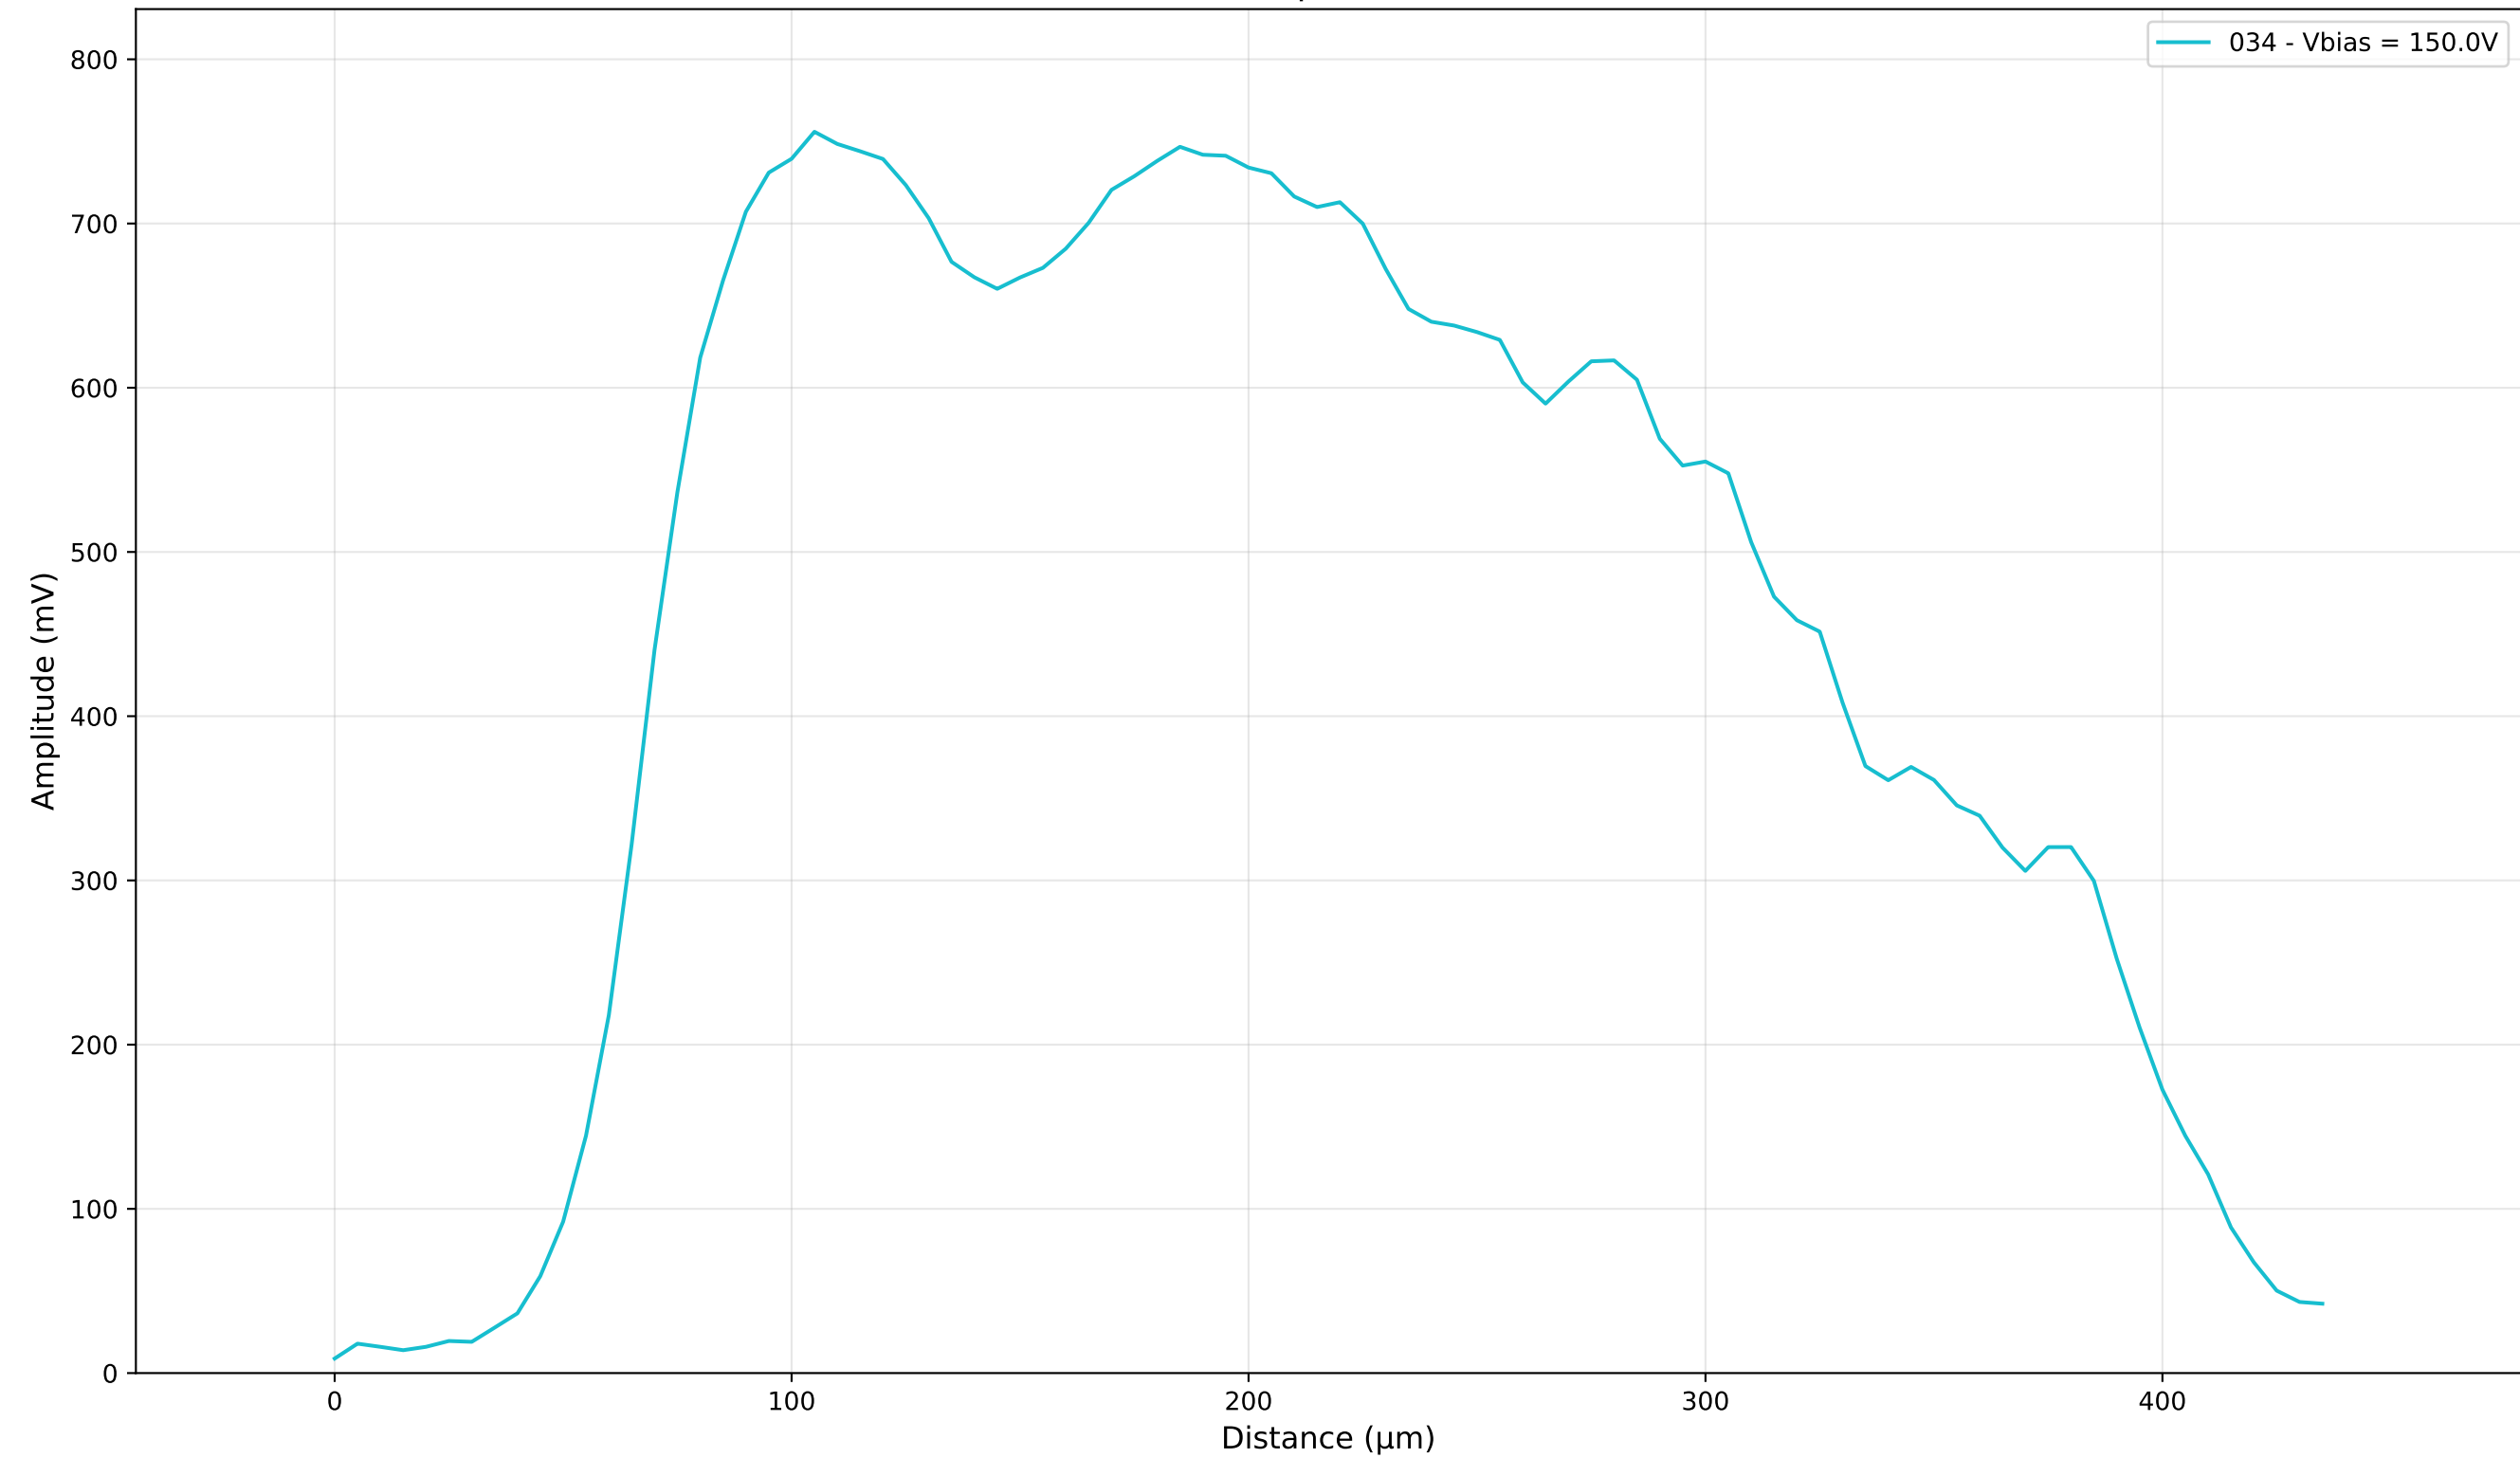


FWHM

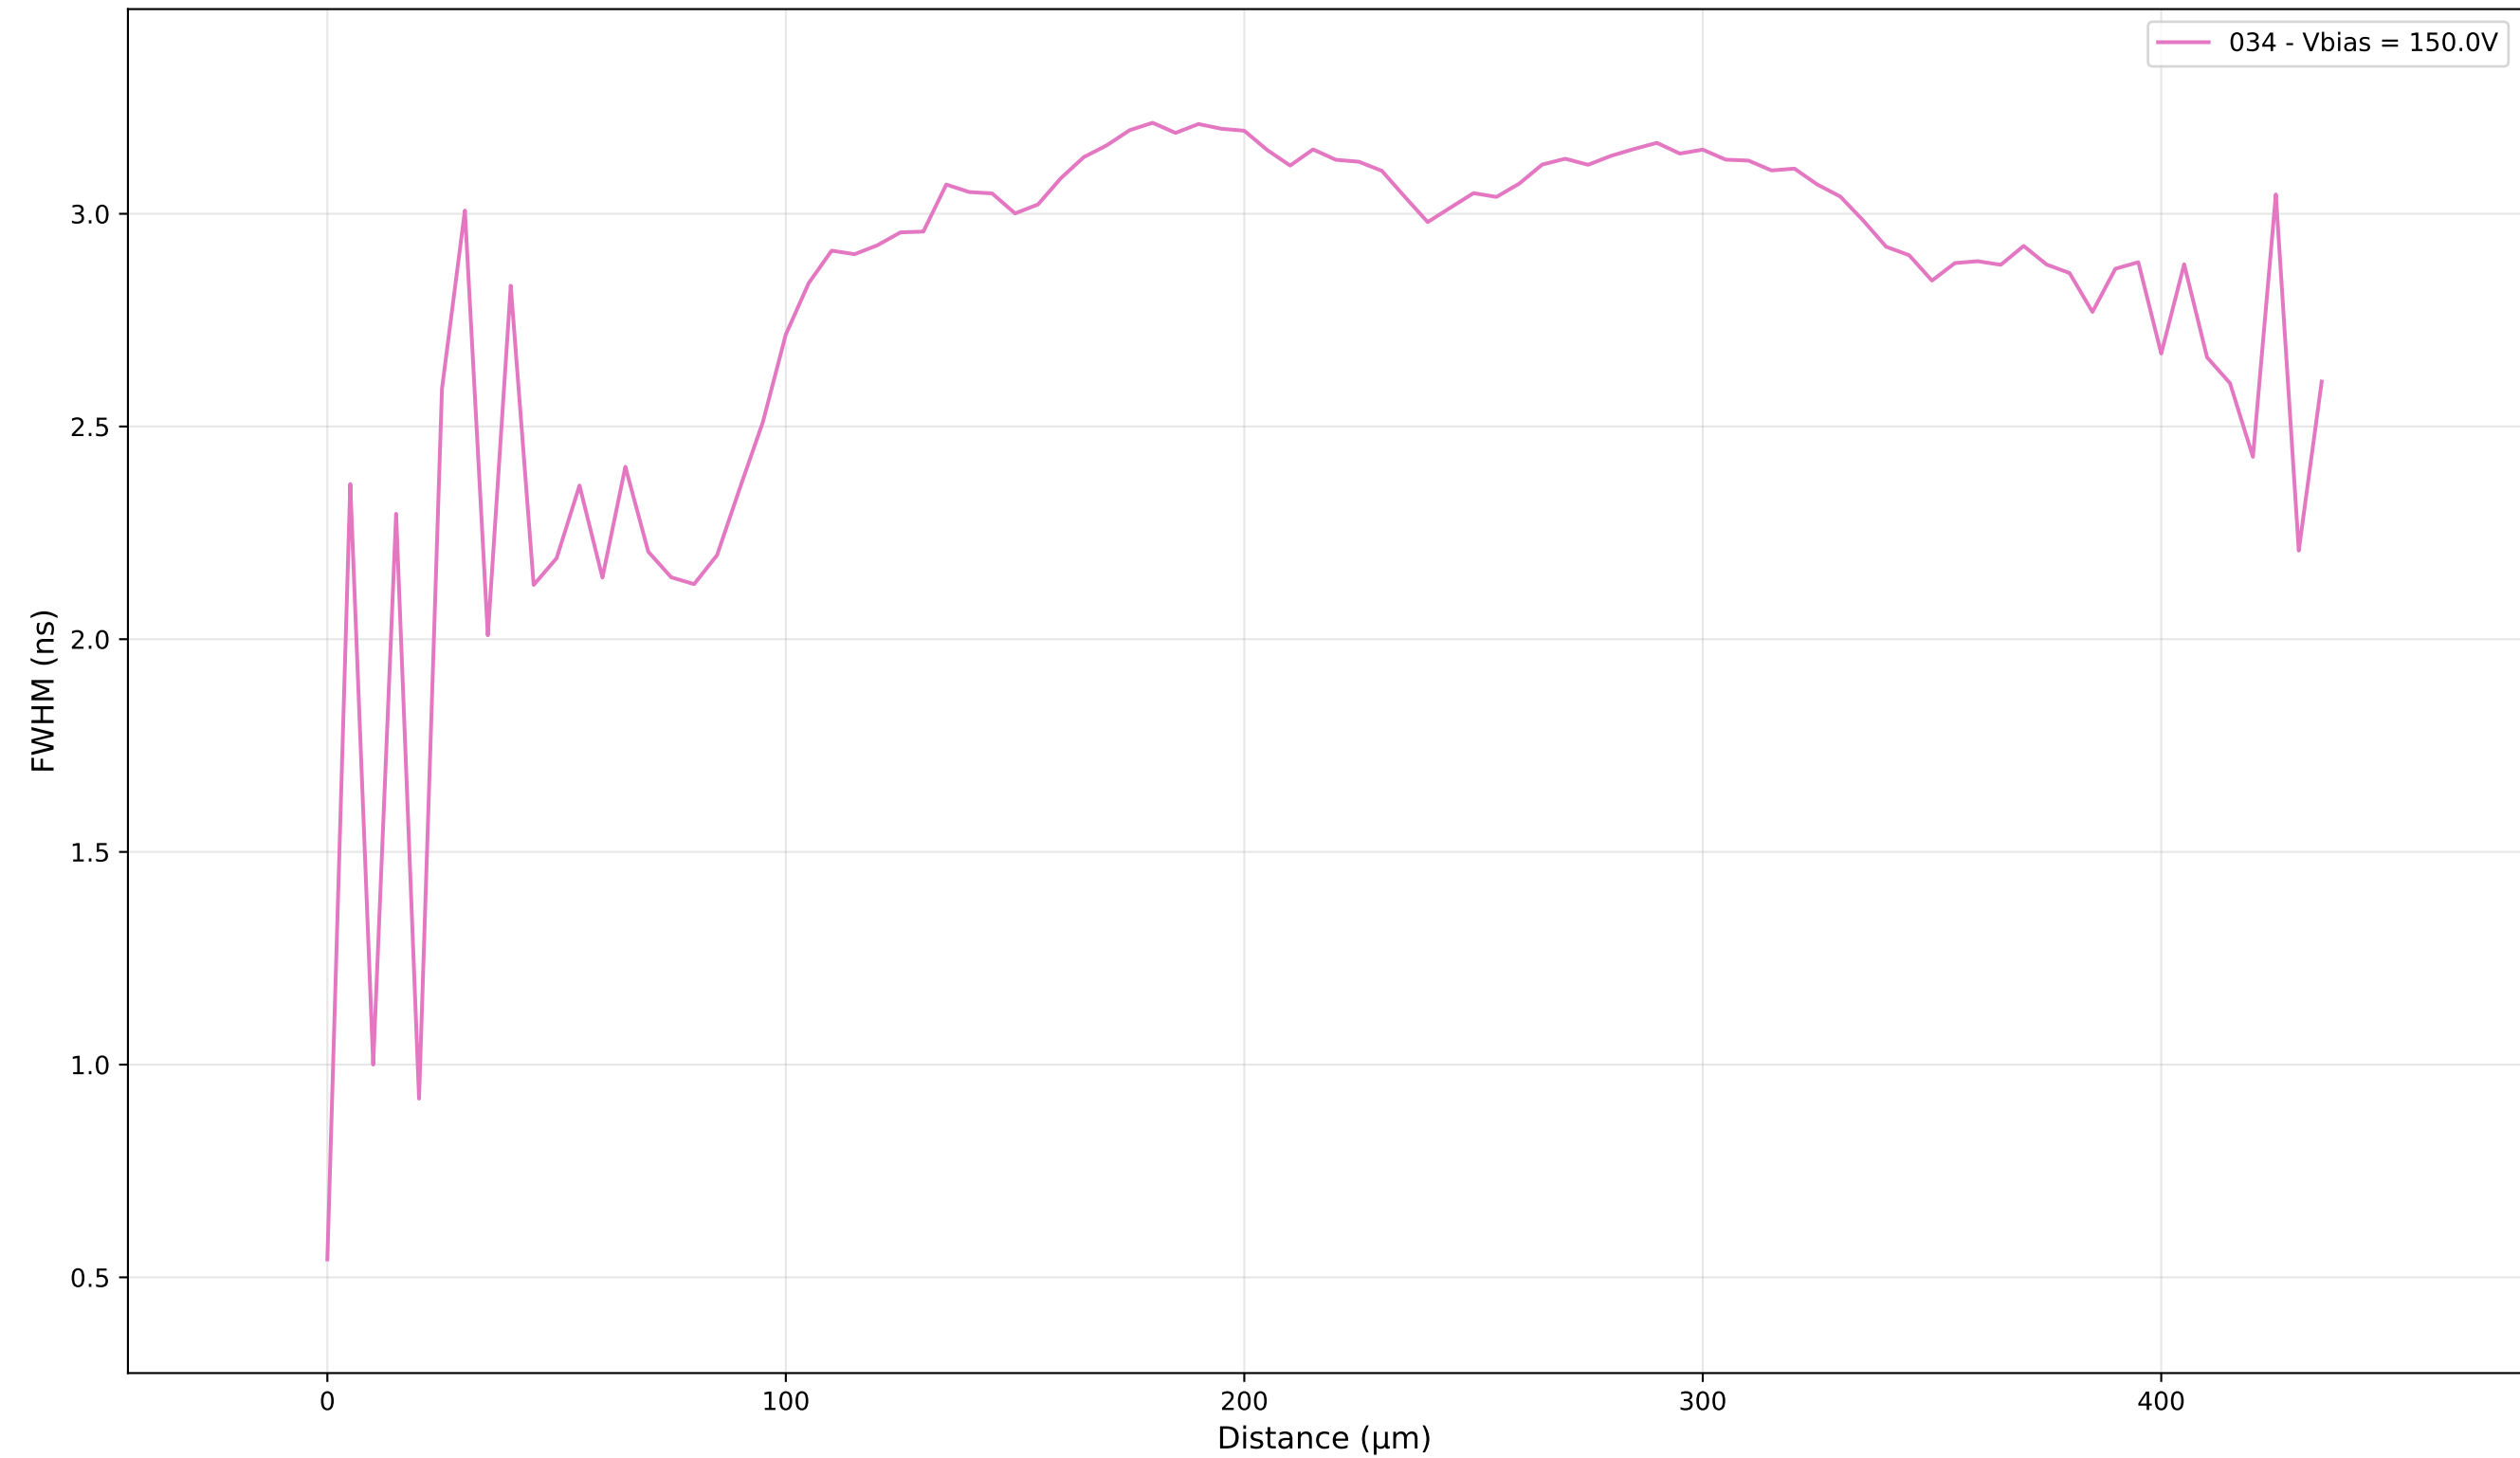


Transient Pulse - Sample: TD_4004 - Position: 0.0 μm - Charge: 0.64 pC - Rise Time: 0.02 ns

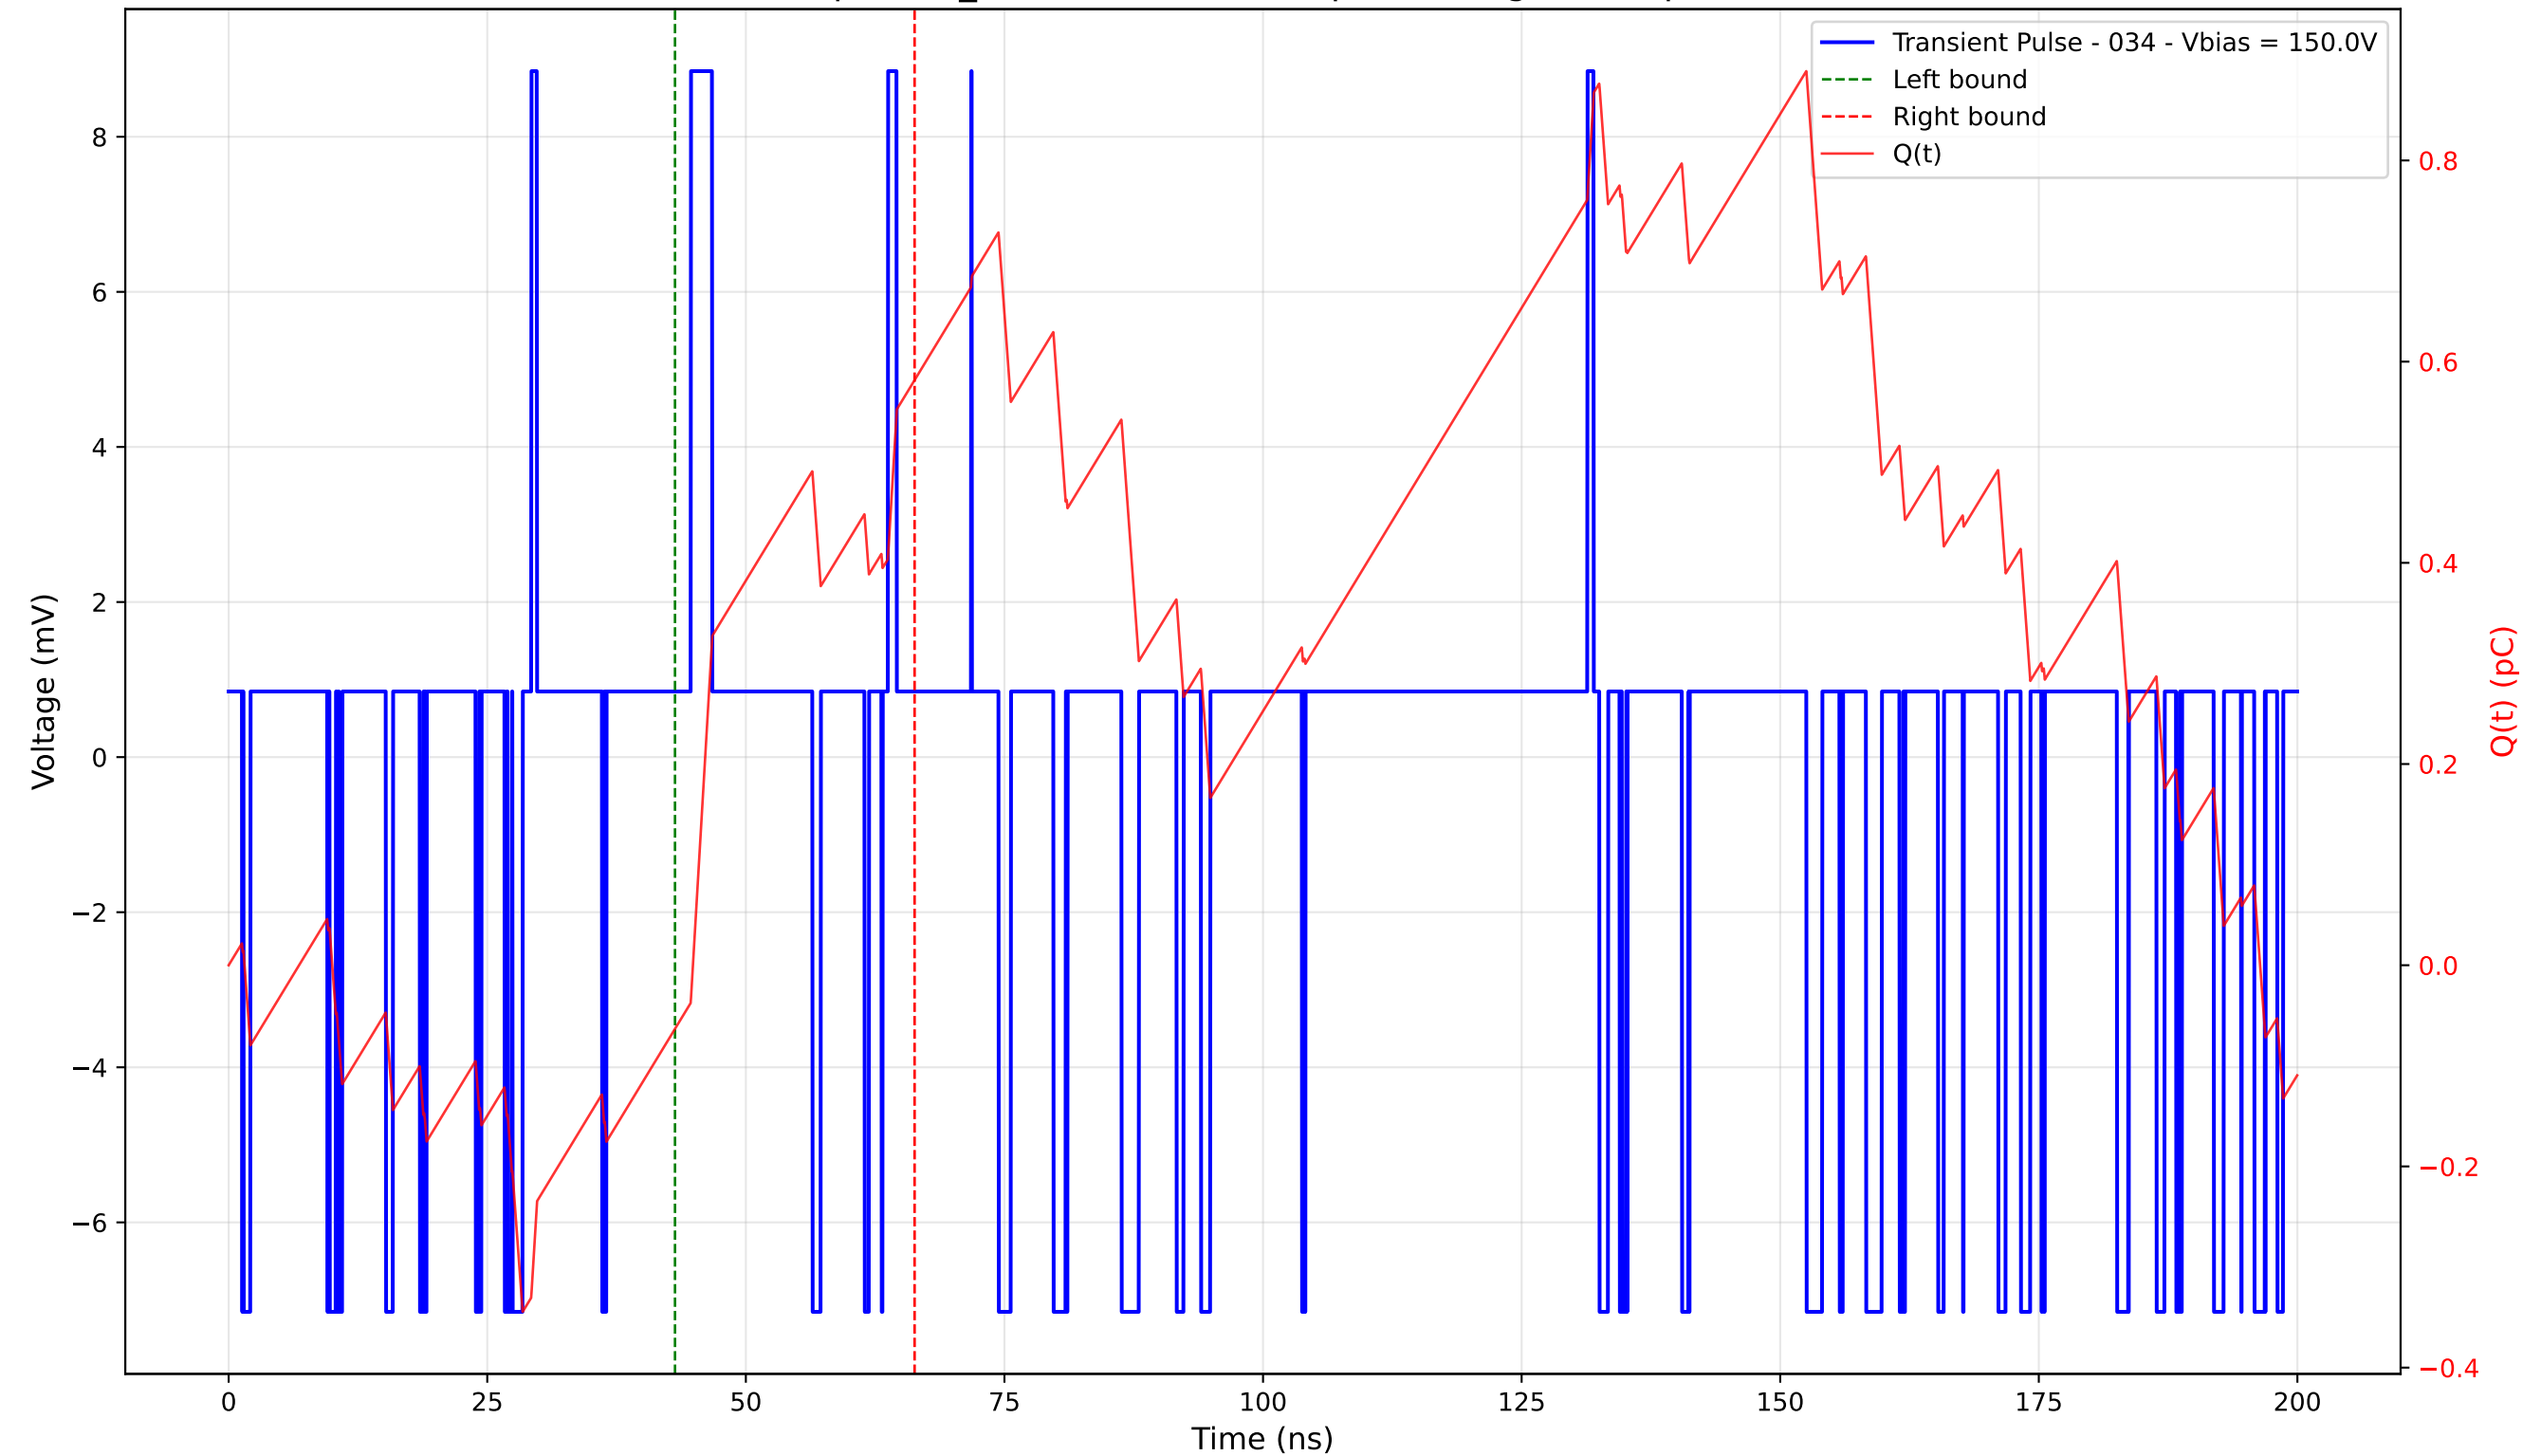


Transient Pulse - Sample: TD_4004 - Position: 5.0 μ m - Charge: 1.65 pC - Rise Time: 0.00 ns (N/A)

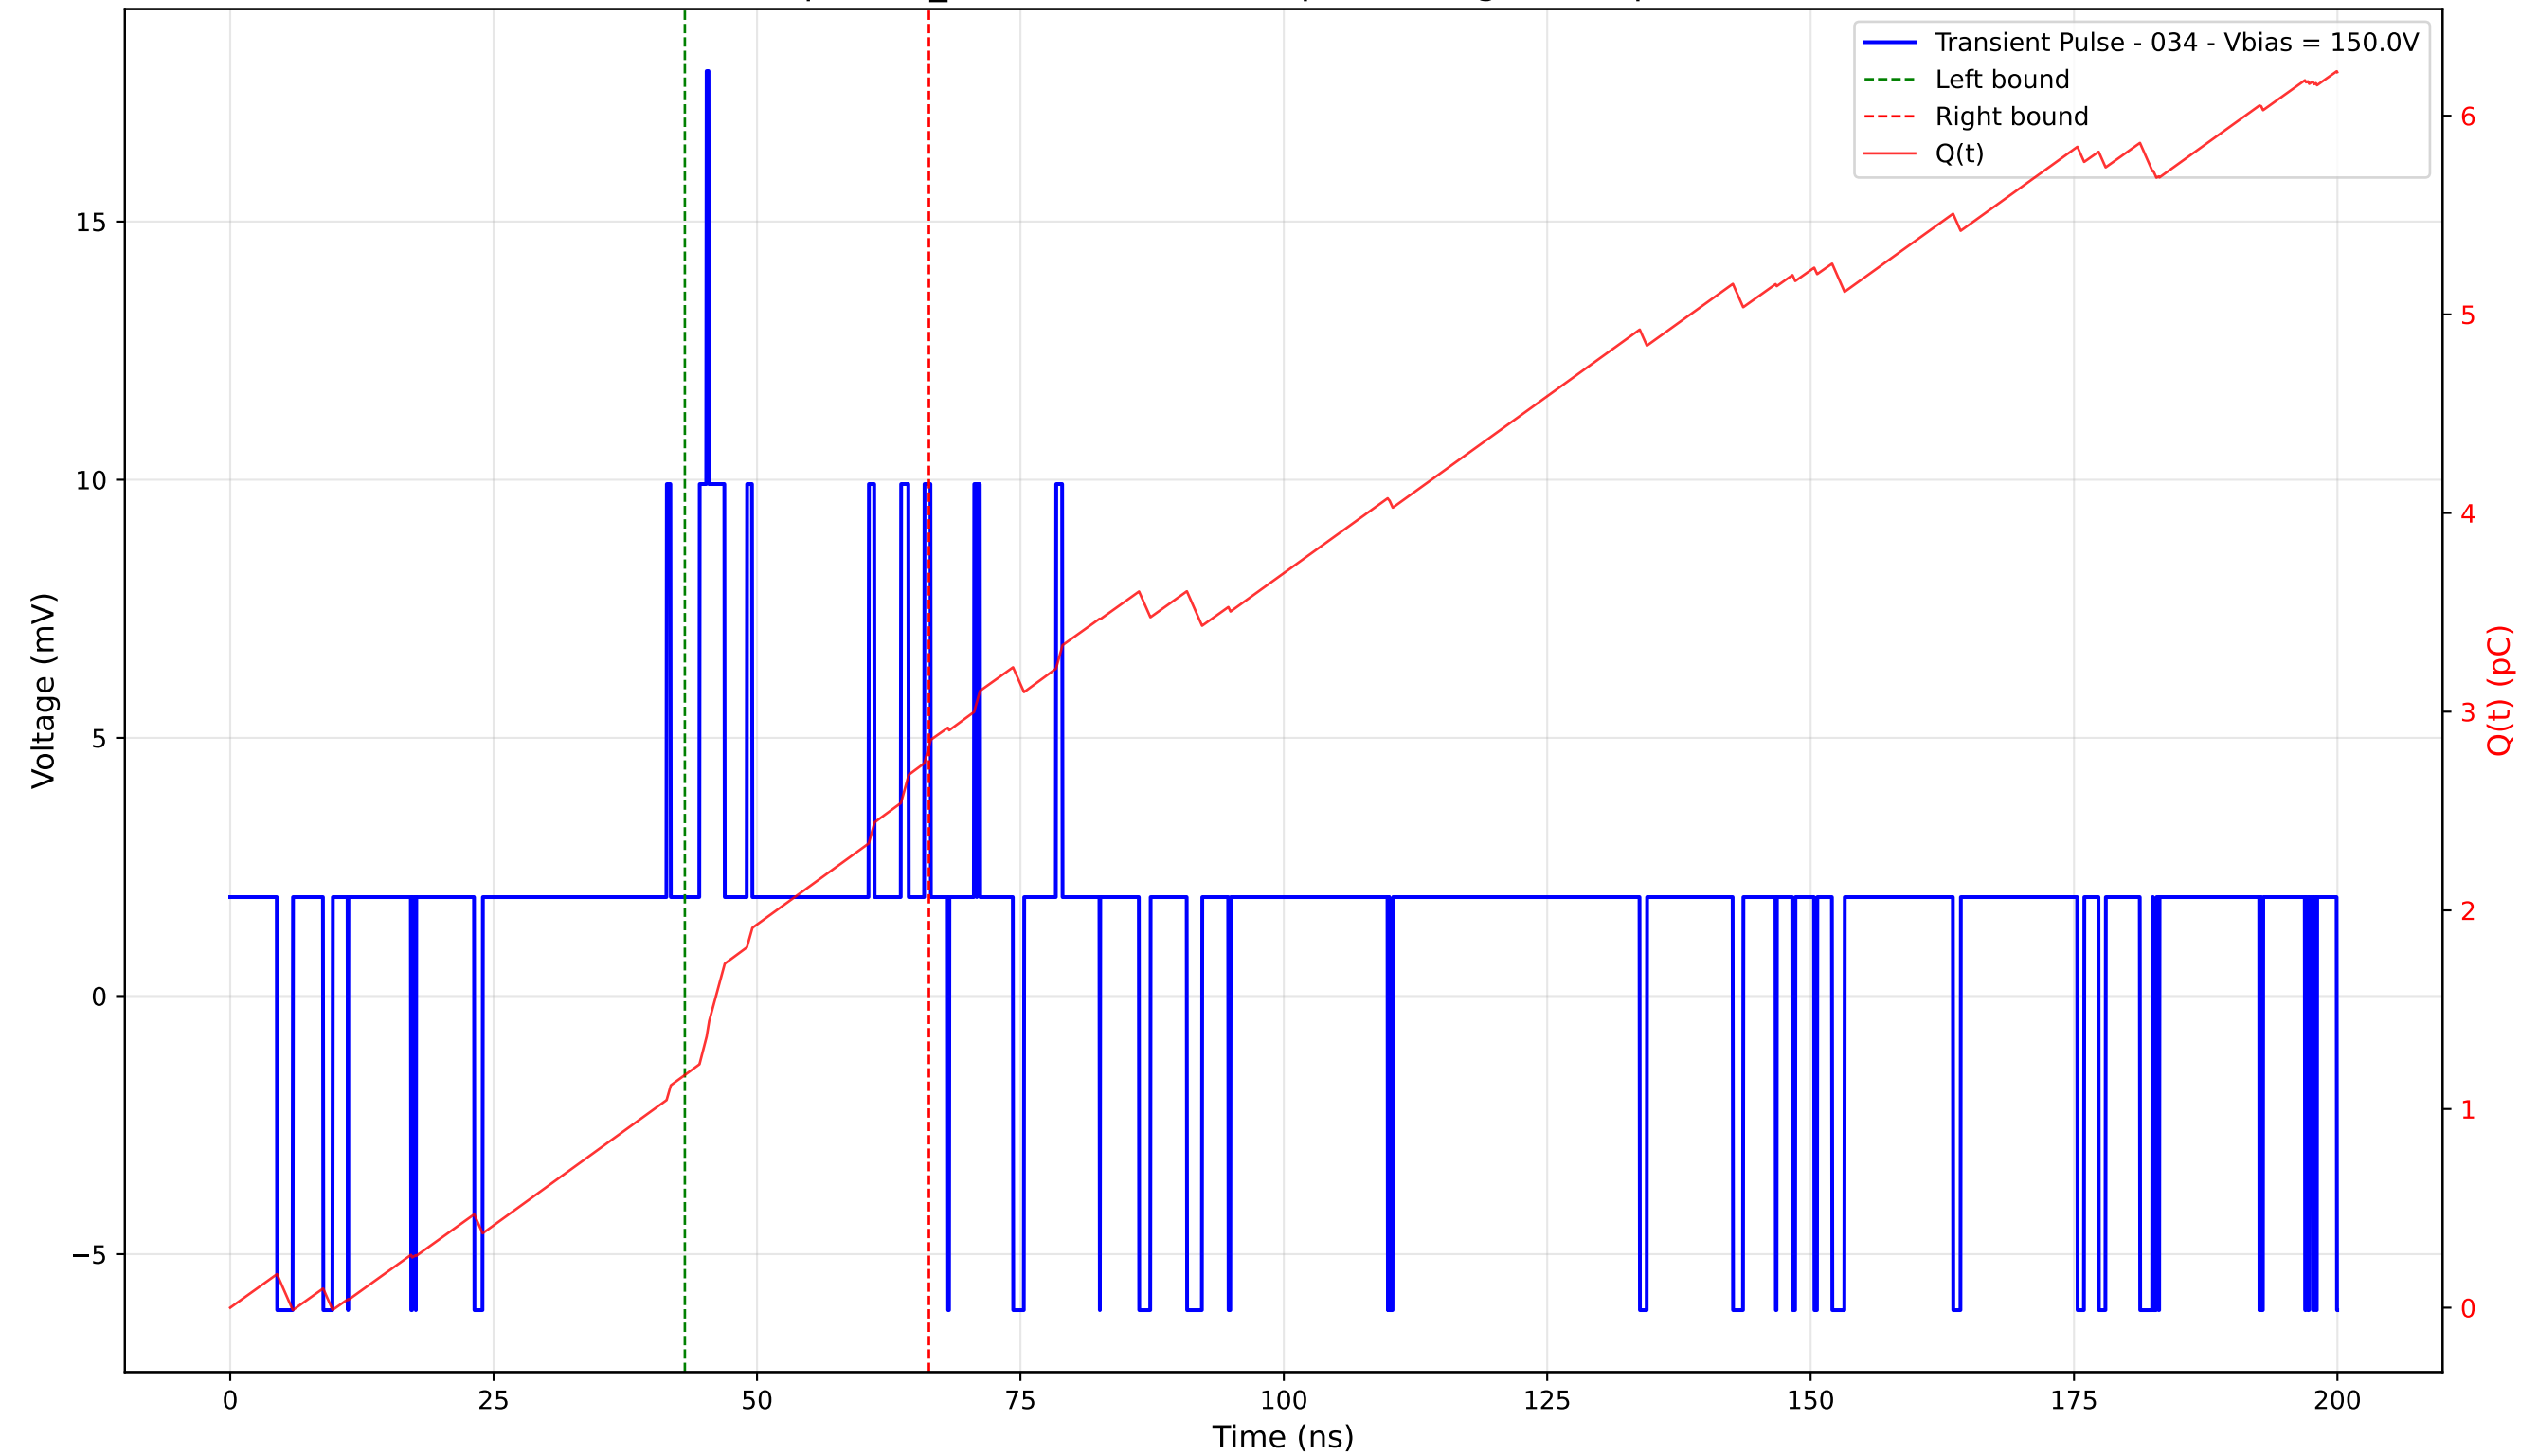


Transient Pulse - Sample: TD_4004 - Position: 10.0 μm - Charge: 2.36 pC - Rise Time: 0.64 ns

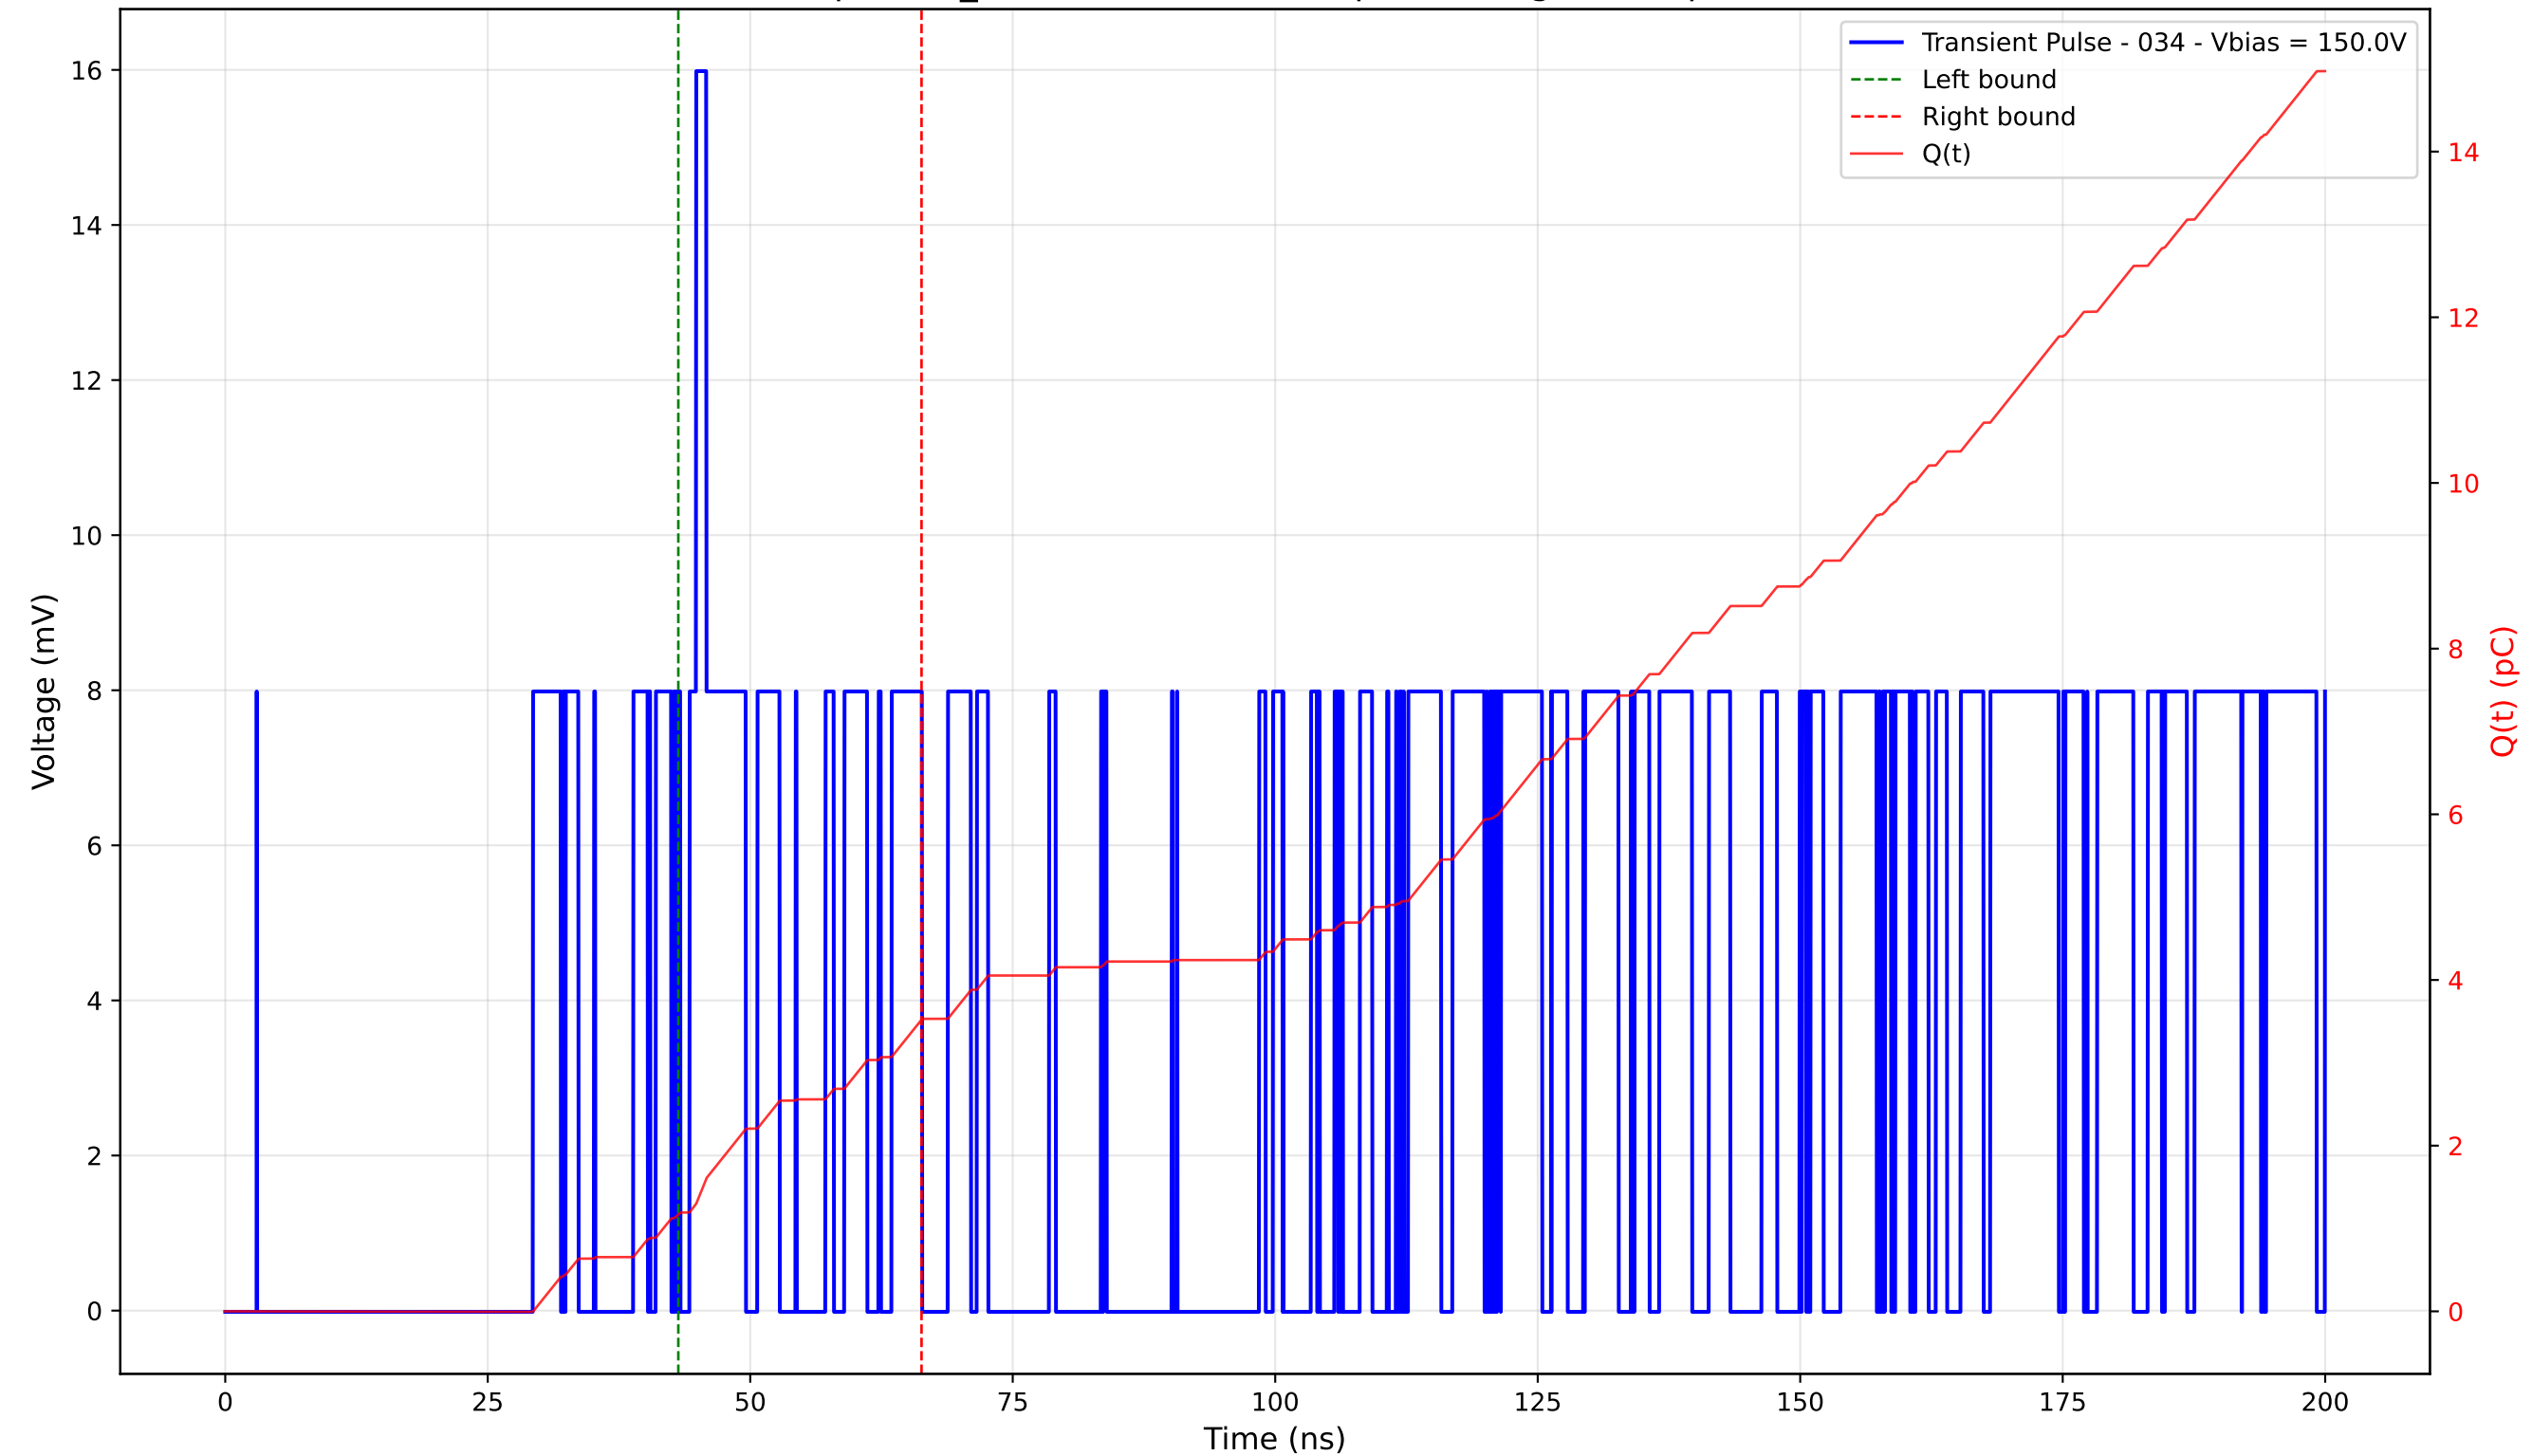


Transient Pulse - Sample: TD_4004 - Position: 15.0 μm - Charge: 2.96 pC - Rise Time: 0.00 ns (N/A)

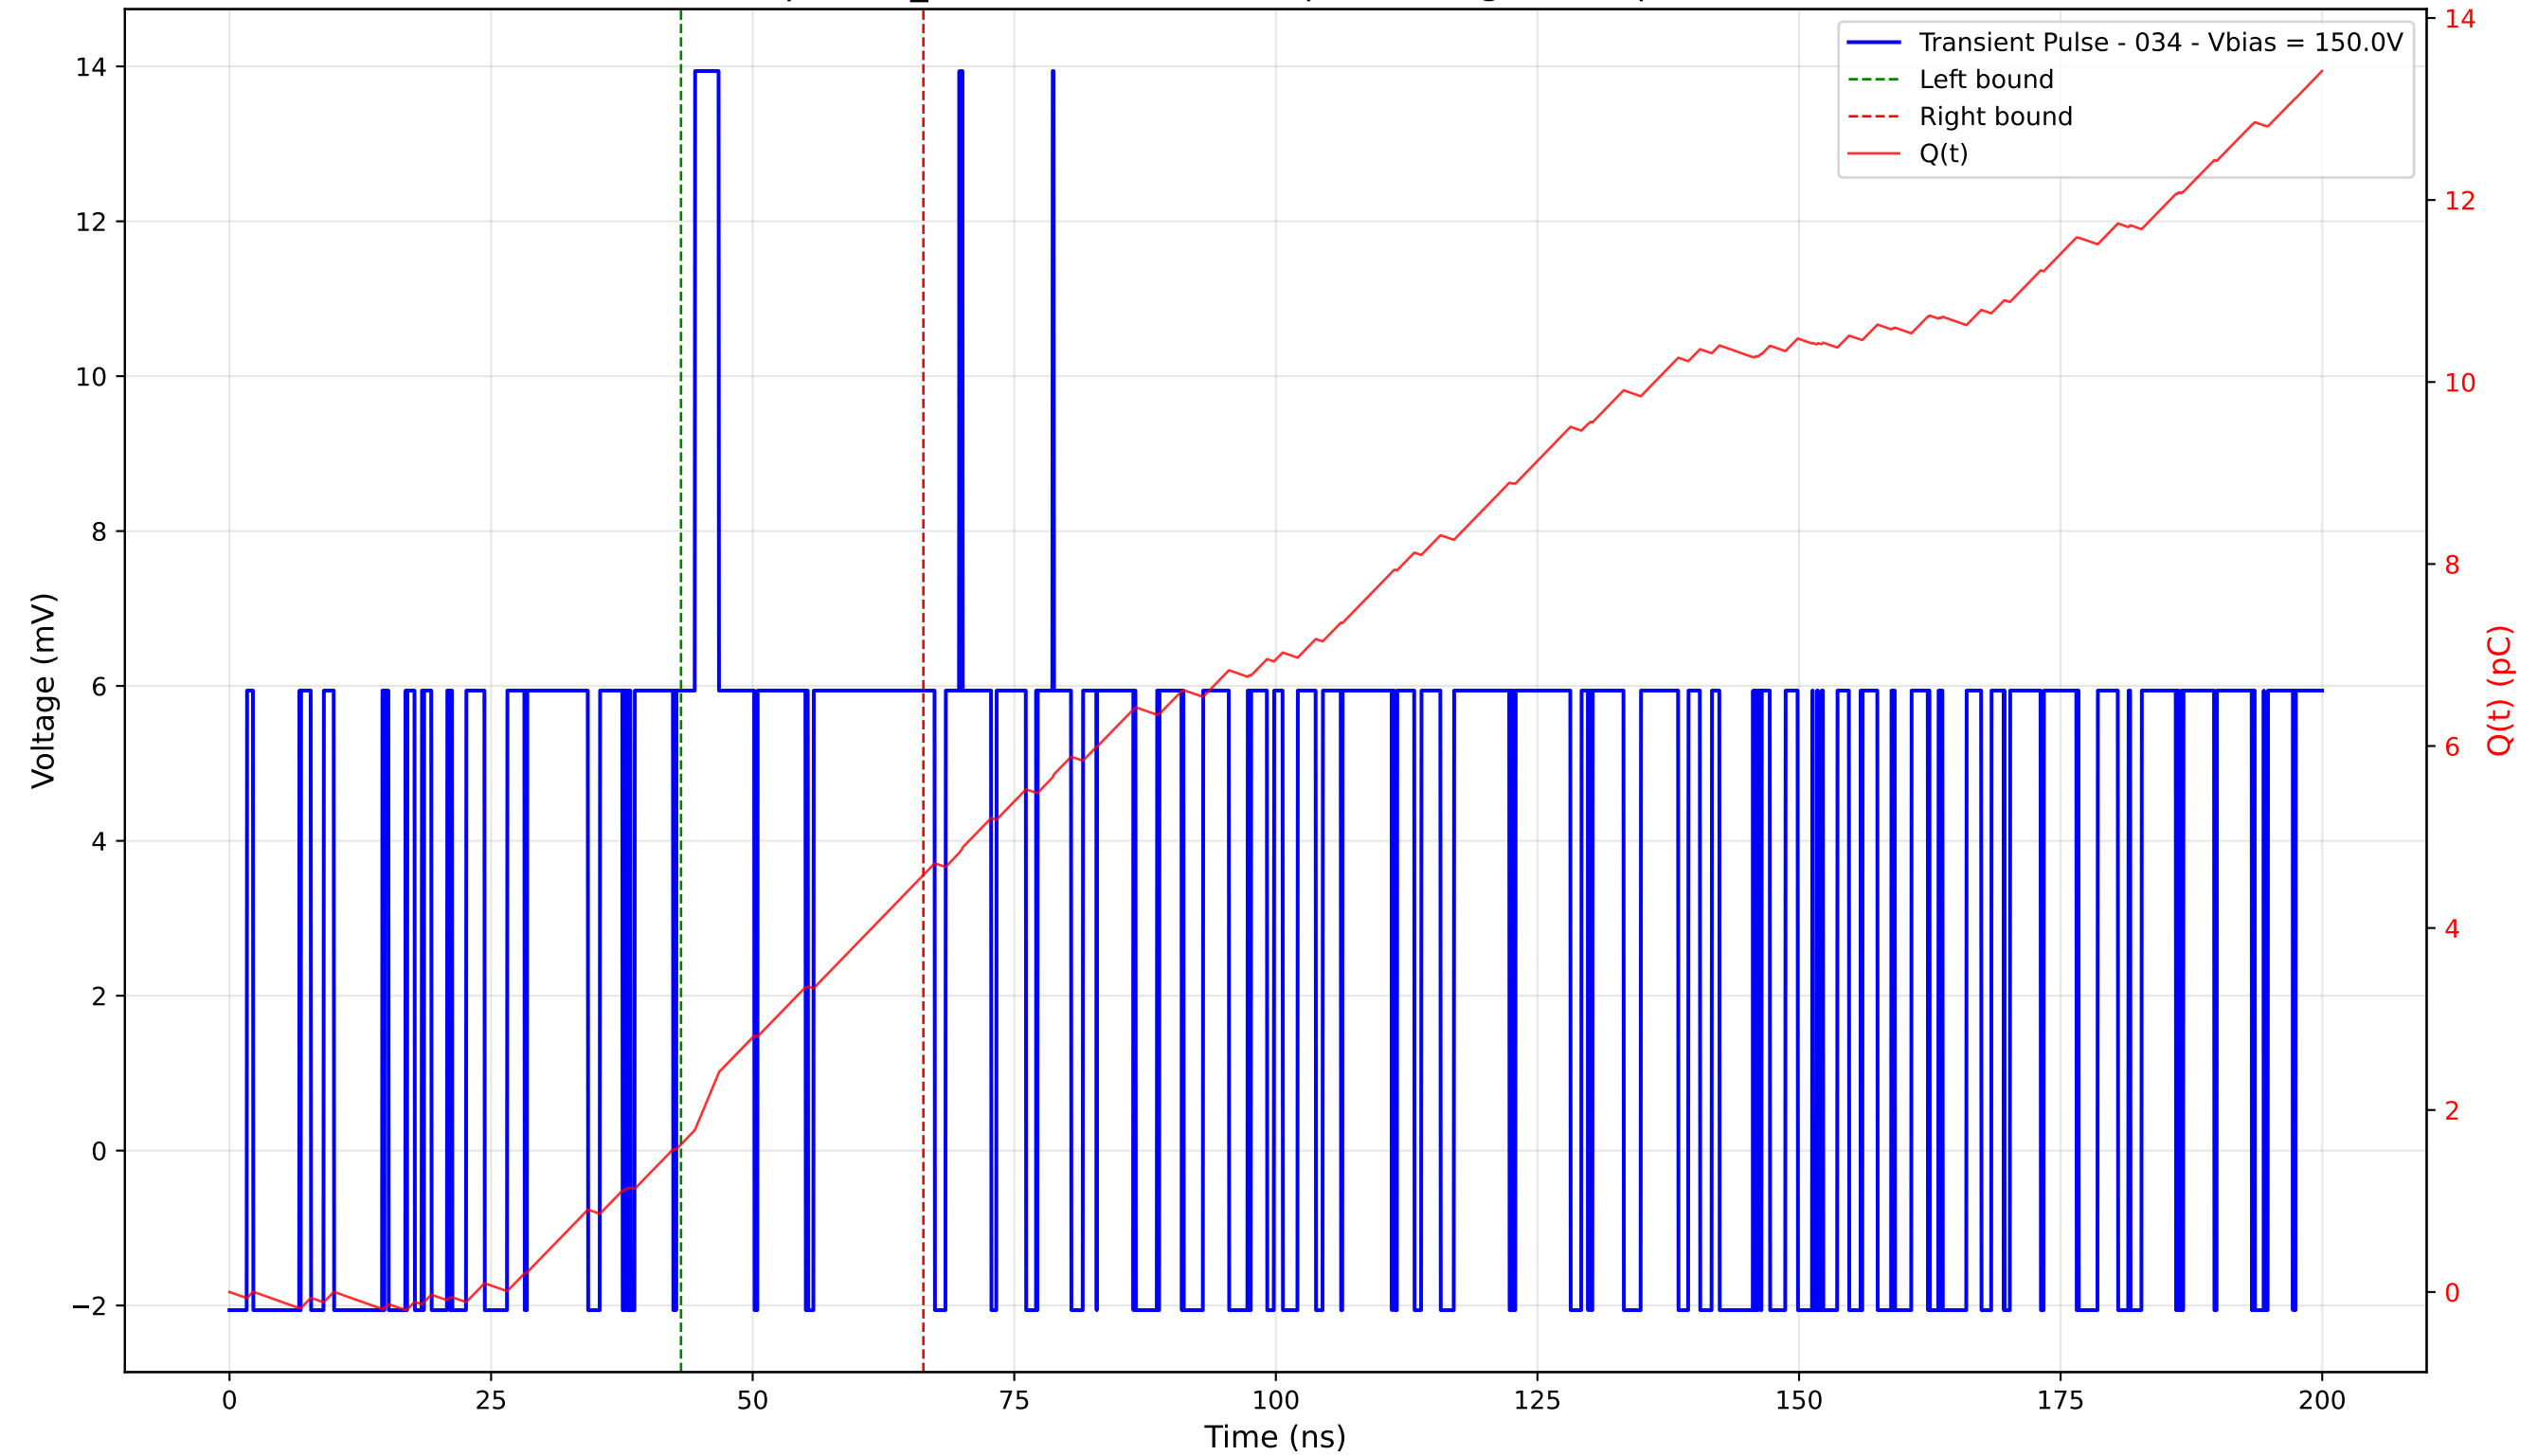


Transient Pulse - Sample: TD_4004 - Position: 20.0 μm - Charge: 0.65 pC - Rise Time: 0.46 ns

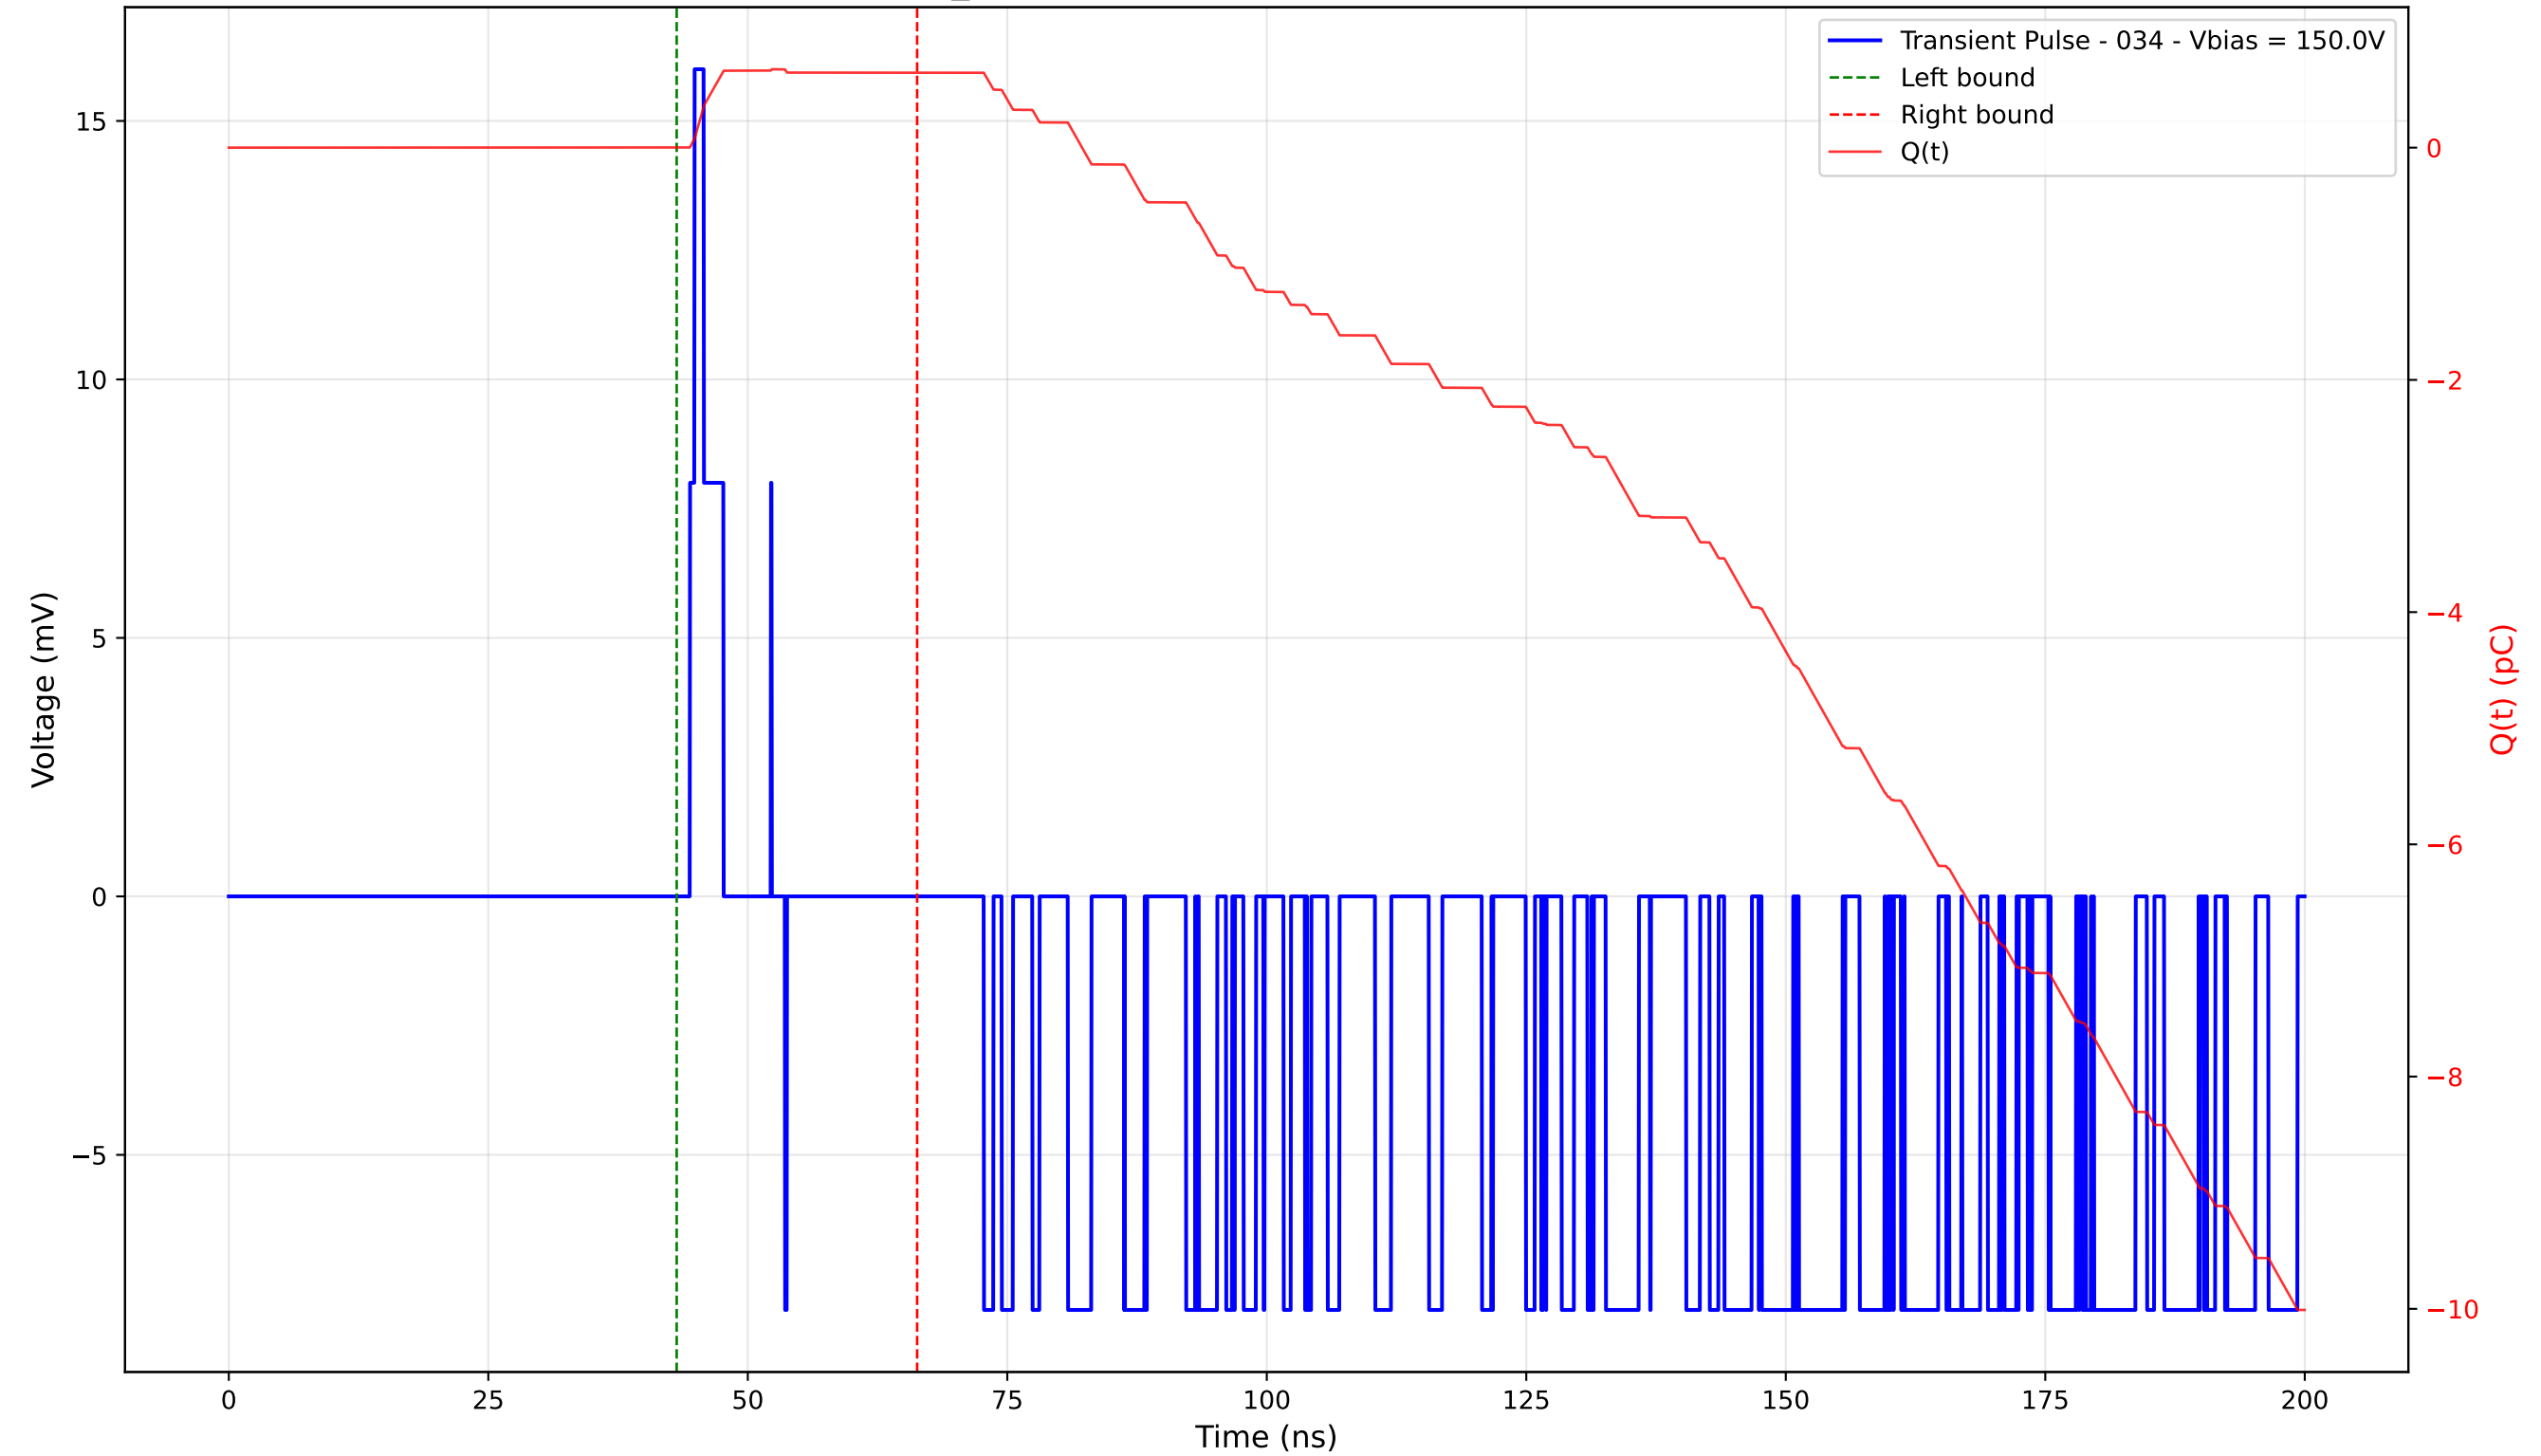


Transient Pulse - Sample: TD_4004 - Position: 25.0 μm - Charge: 1.65 pC - Rise Time: 0.00 ns (N/A)

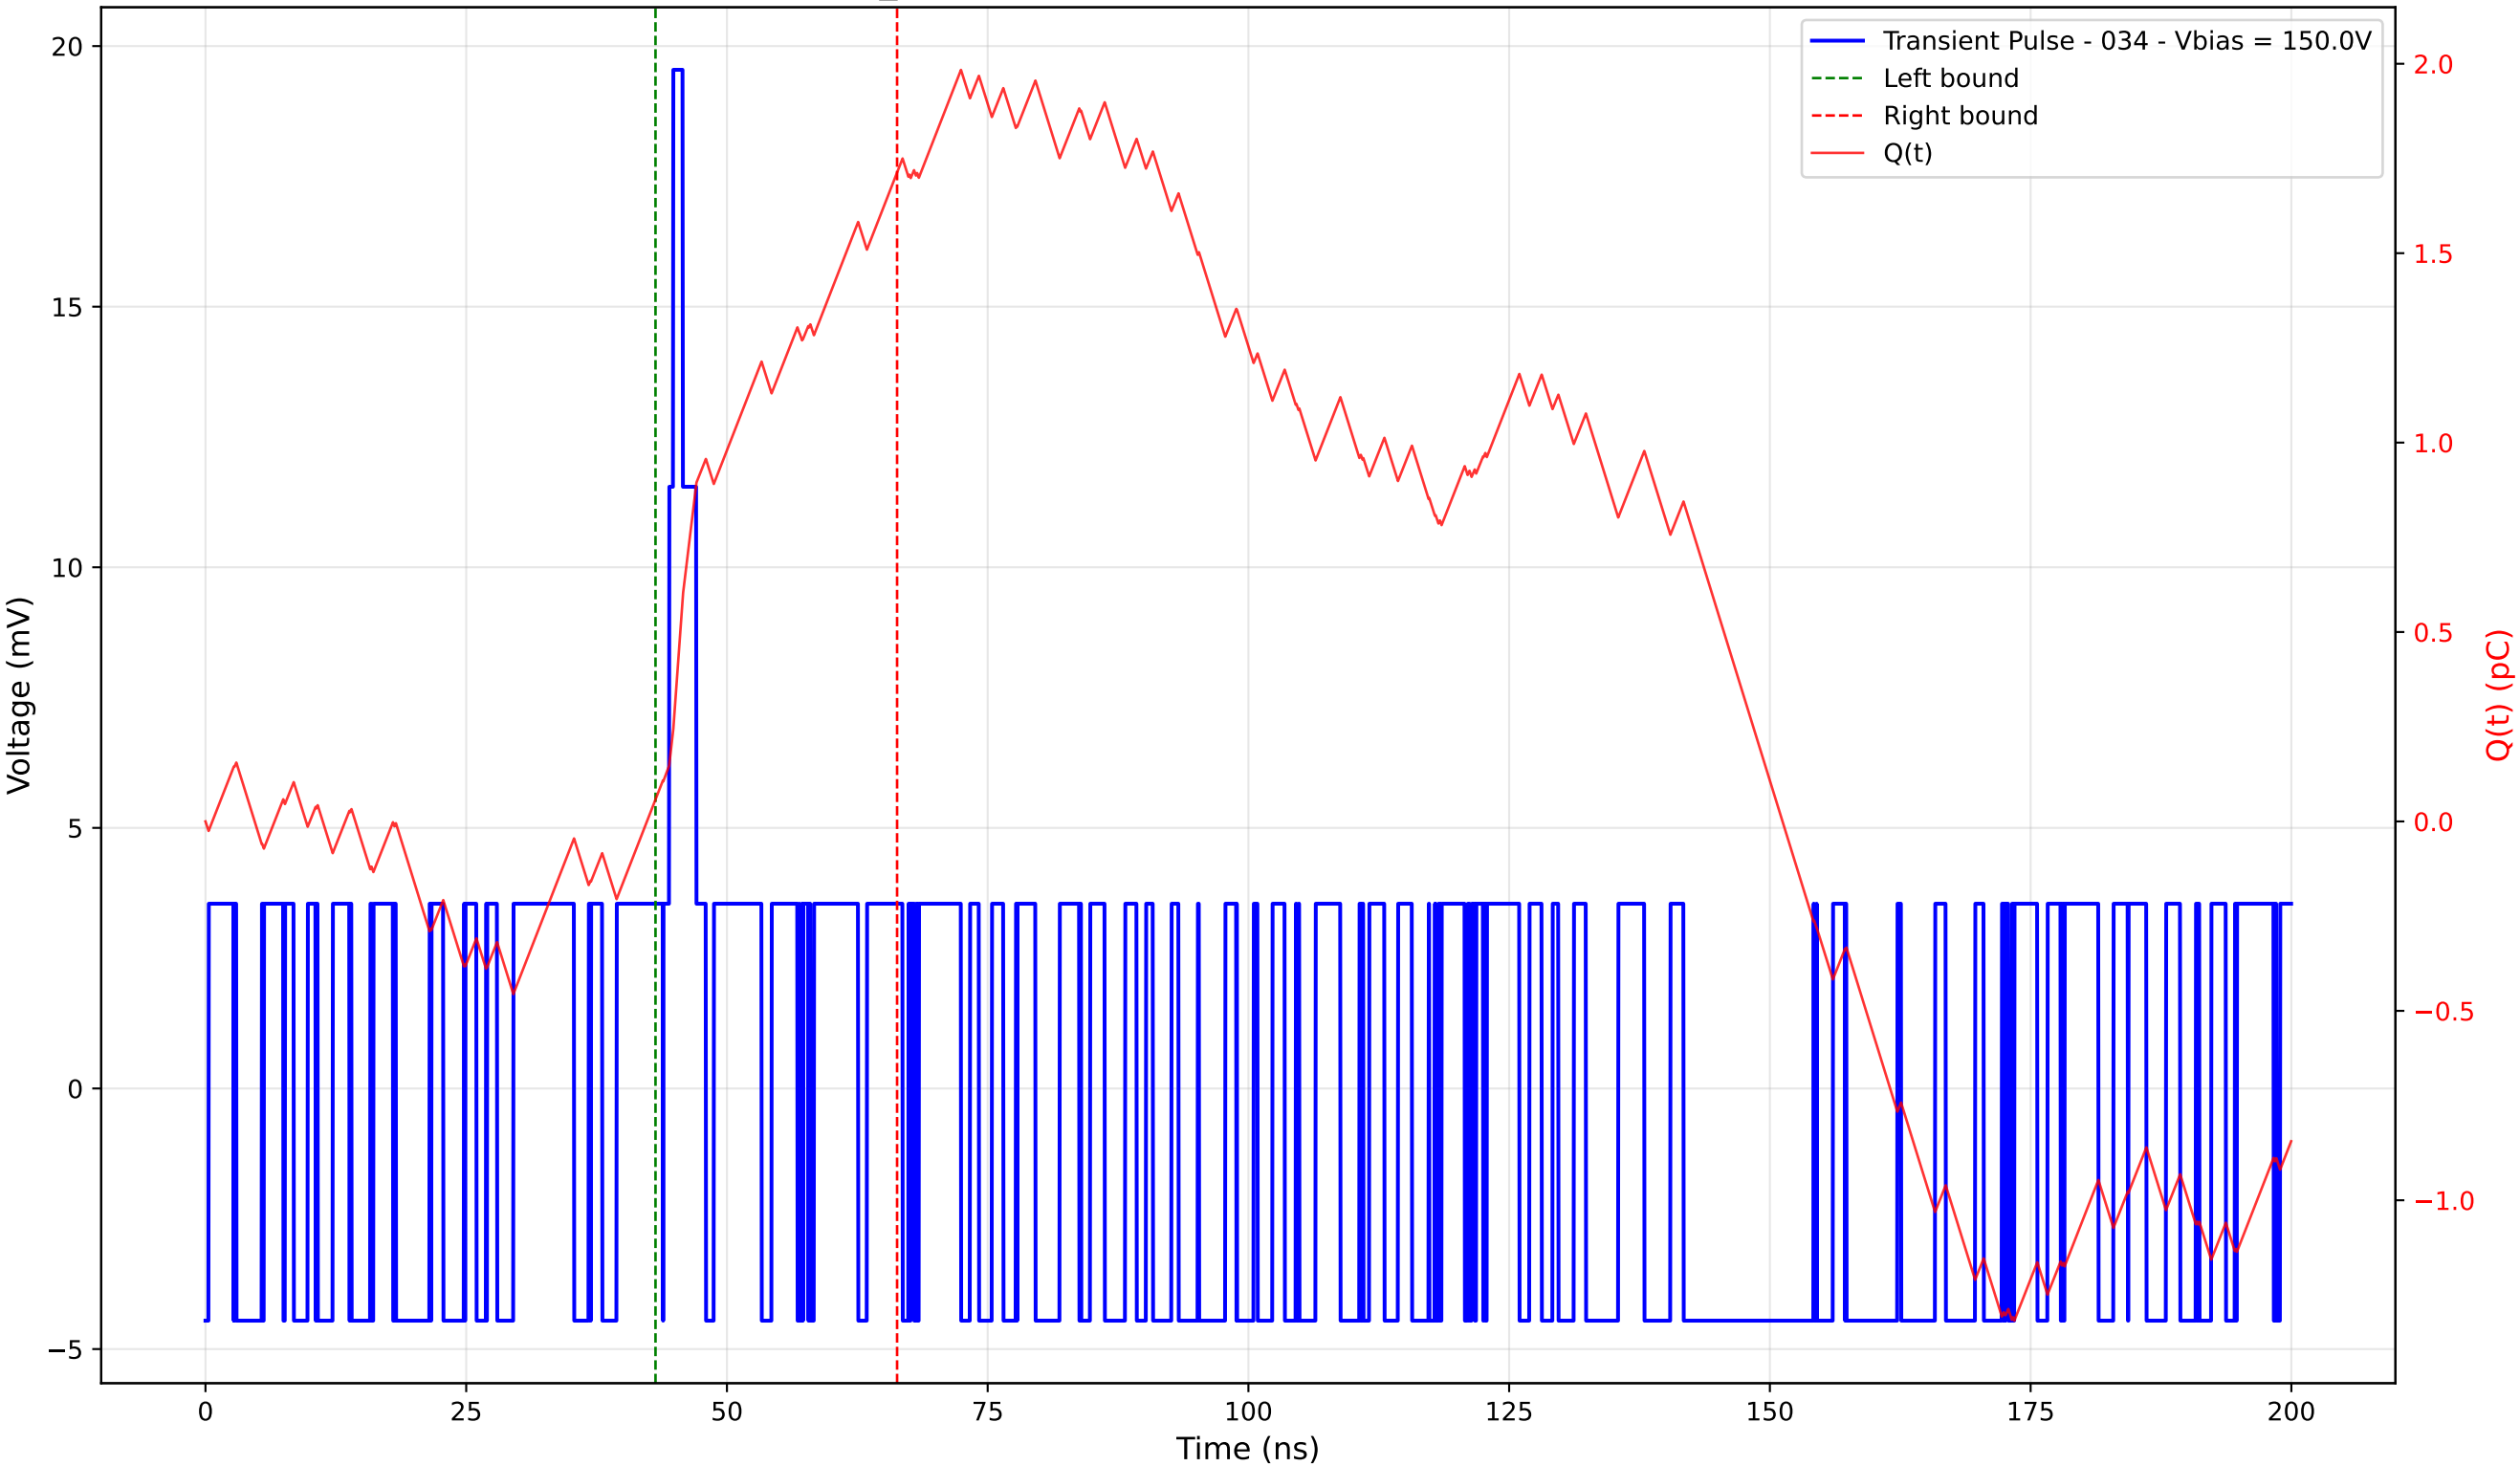


Transient Pulse - Sample: TD_4004 - Position: 30.0 μm - Charge: 2.14 pC - Rise Time: 0.00 ns (N/A)

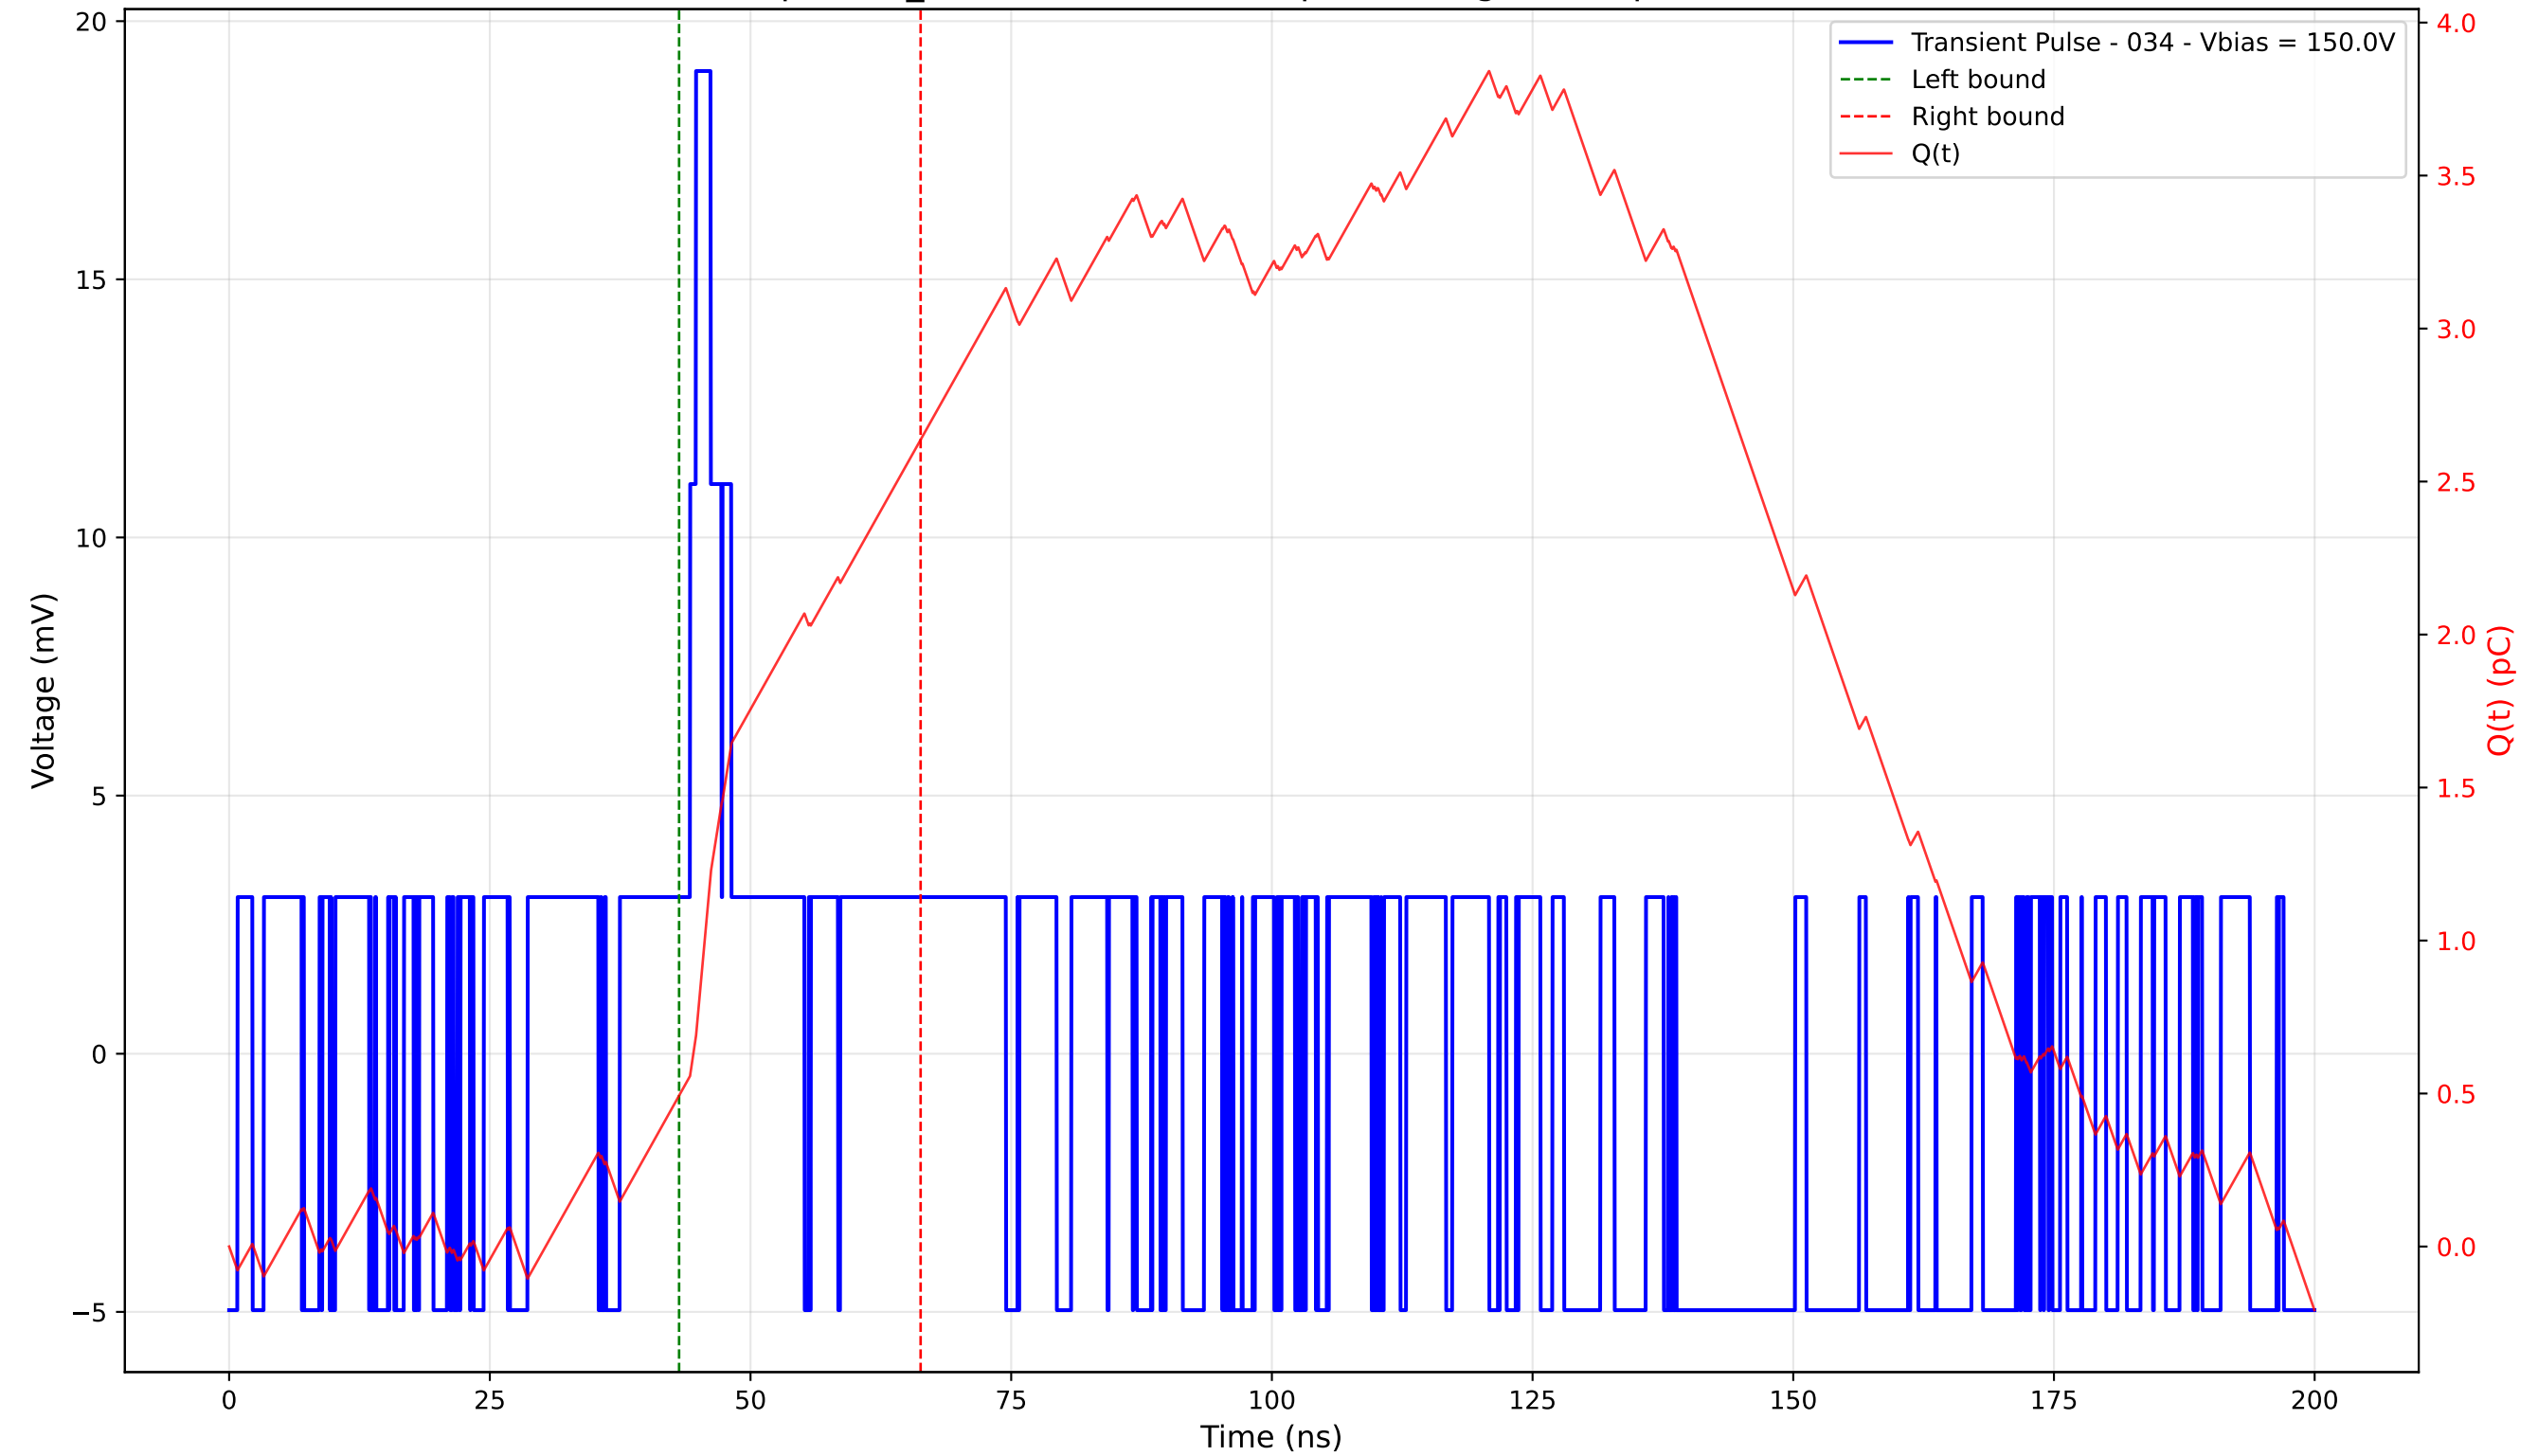


Transient Pulse - Sample: TD_4004 - Position: 35.0 μm - Charge: 1.22 pC - Rise Time: 0.00 ns (N/A)

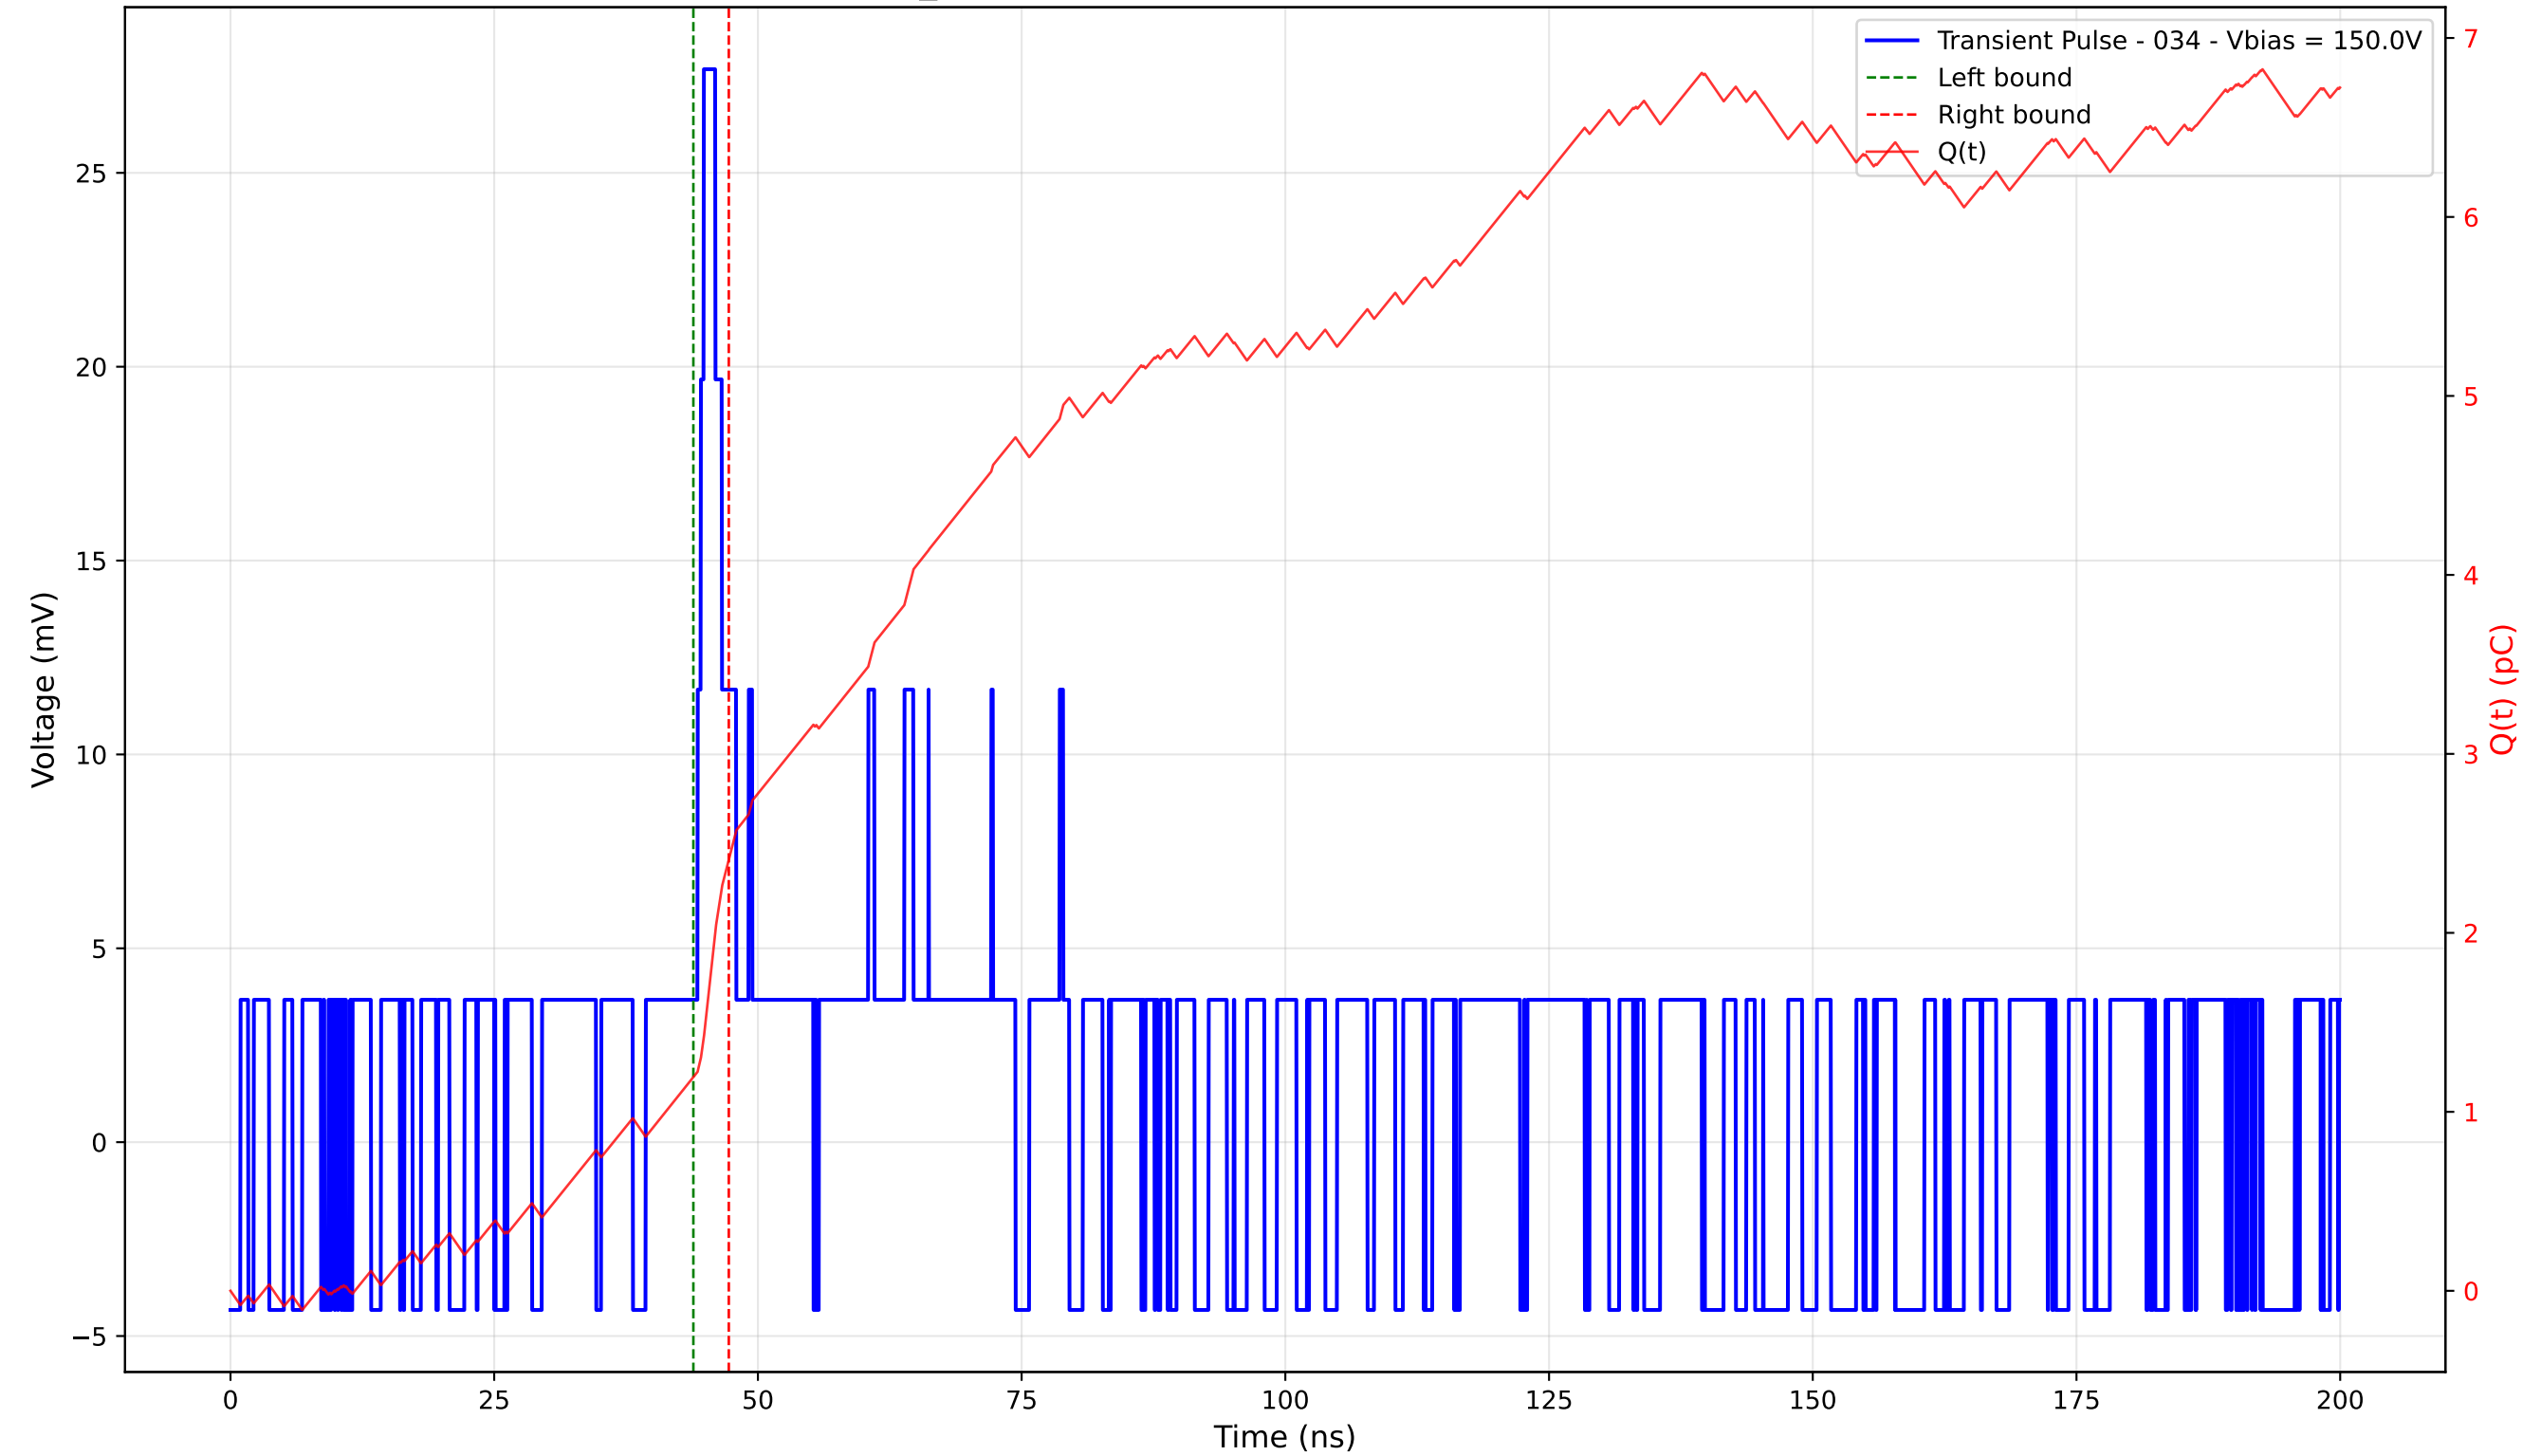


Transient Pulse - Sample: TD_4004 - Position: 40.0 μm - Charge: 1.86 pC - Rise Time: 5.56 ns

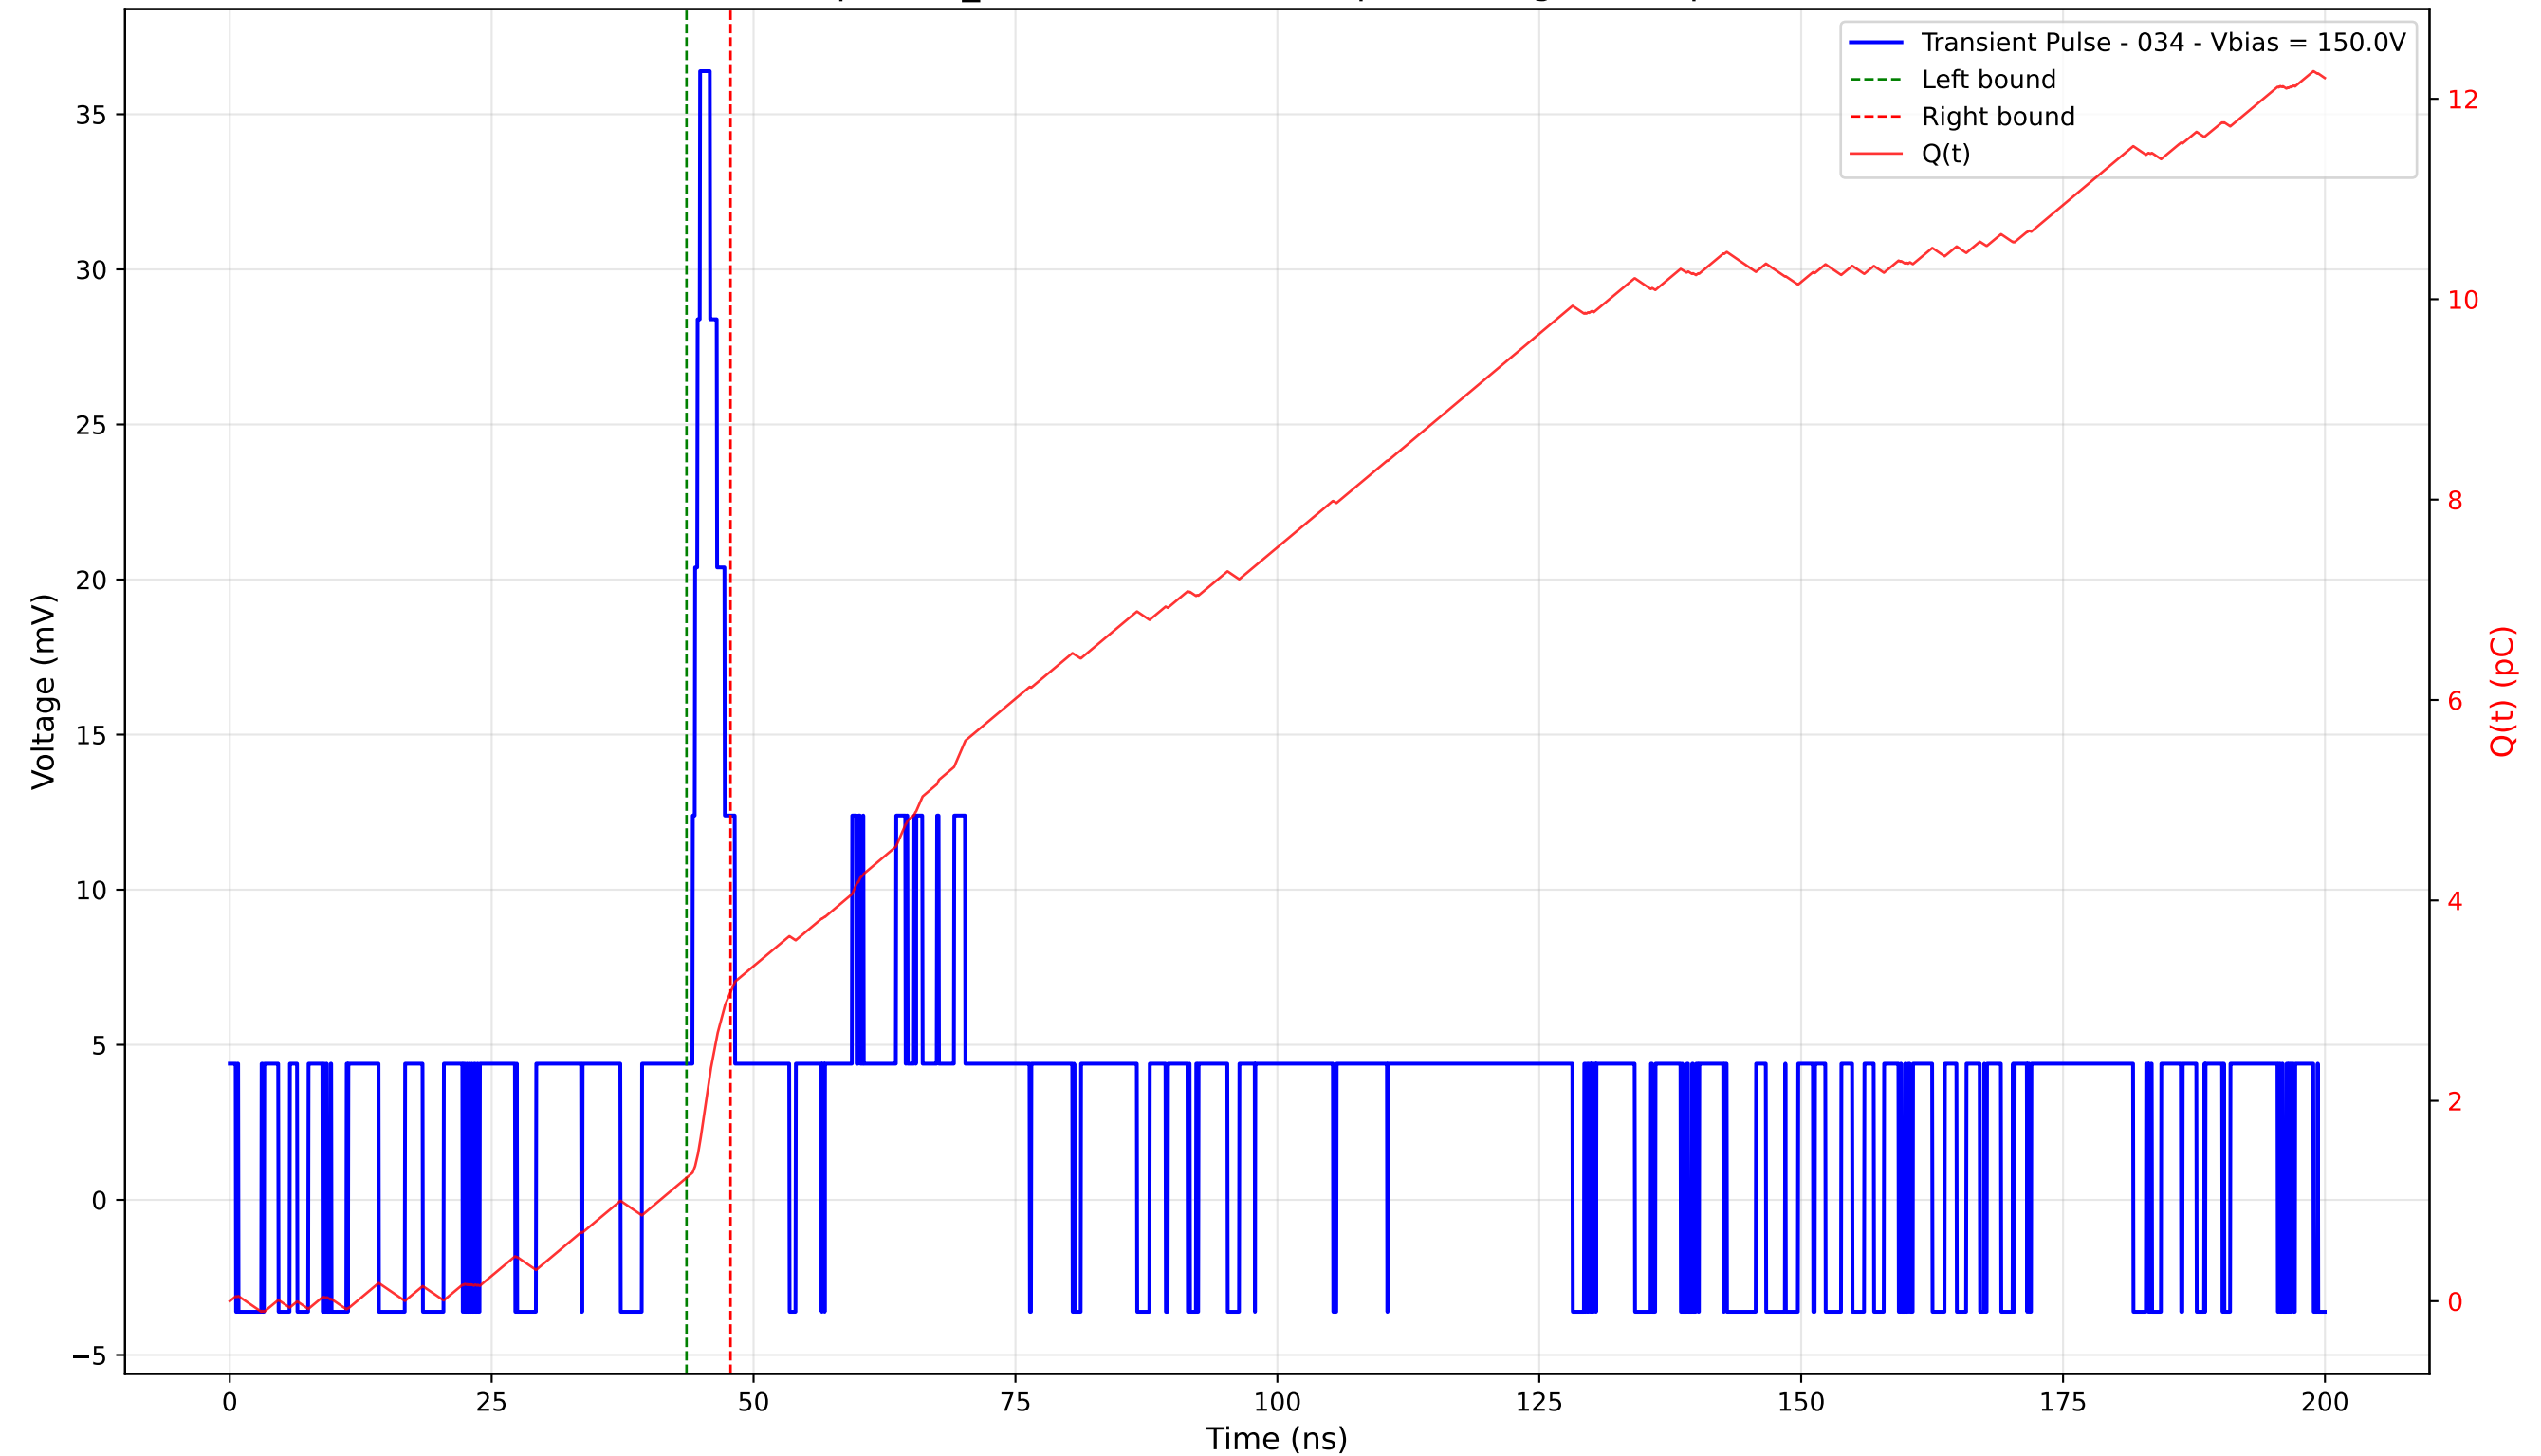


Transient Pulse - Sample: TD_4004 - Position: 45.0 μm - Charge: 2.97 pC - Rise Time: 0.95 ns

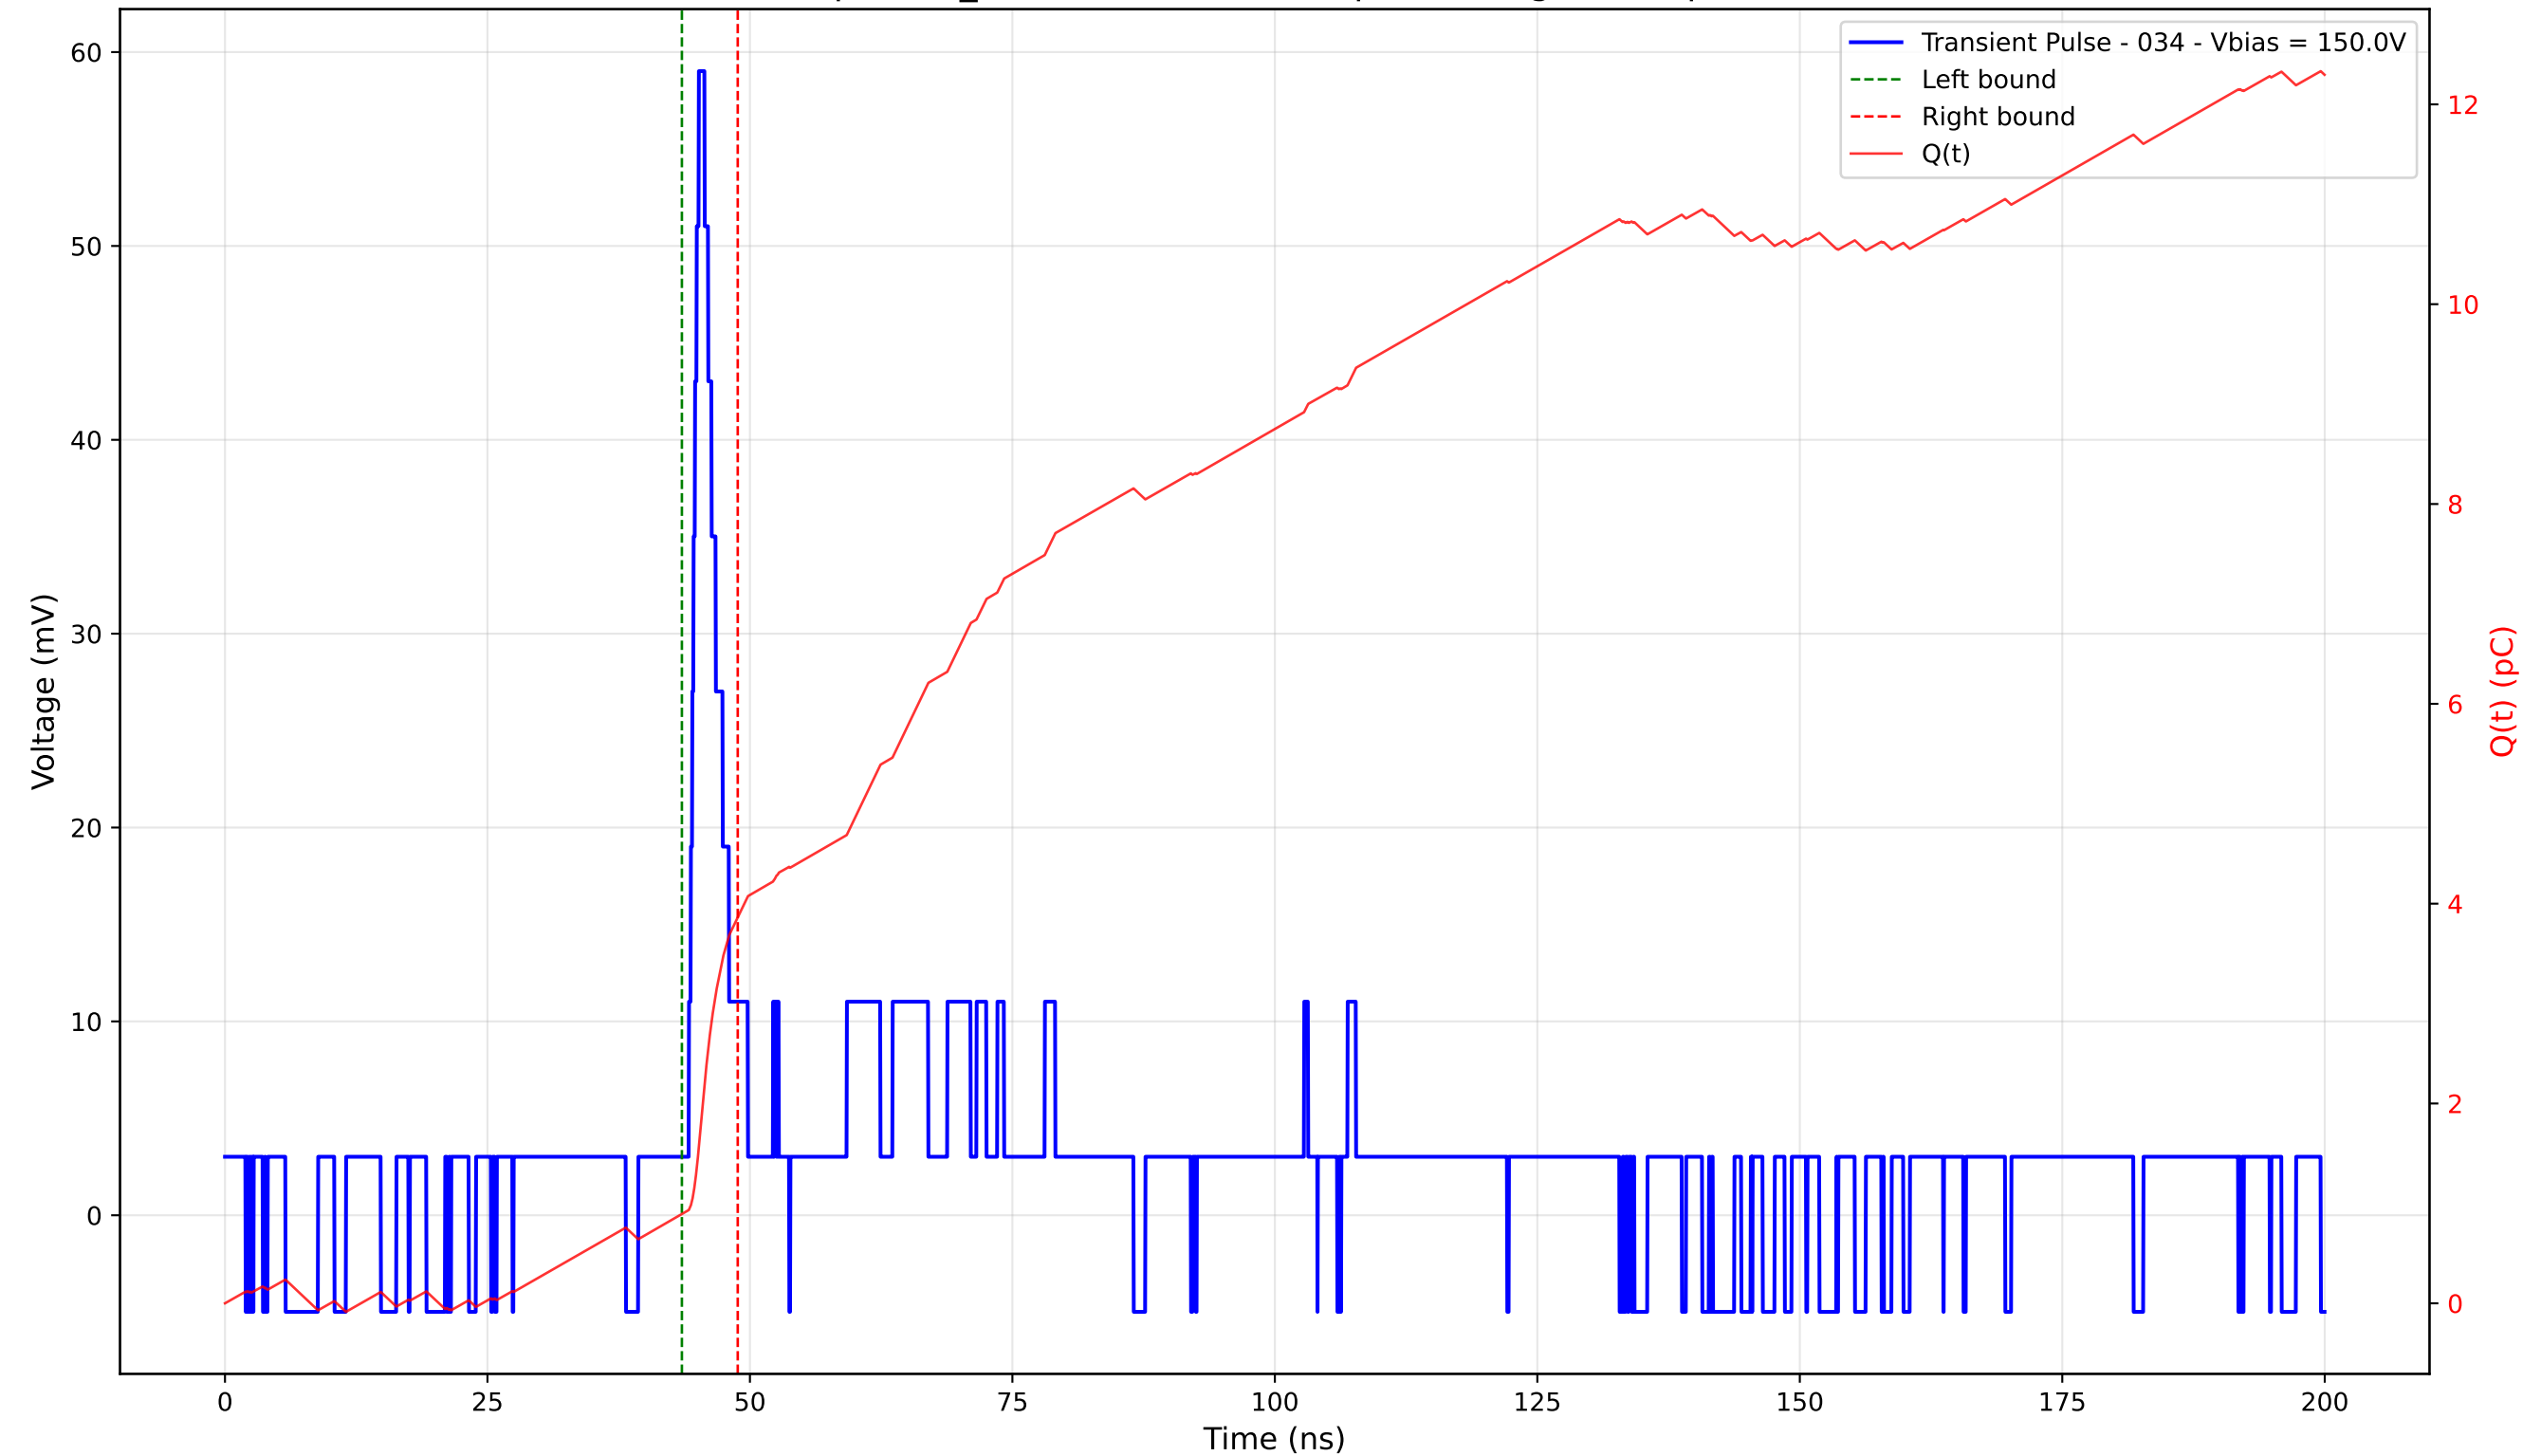


Transient Pulse - Sample: TD_4004 - Position: 50.0 μm - Charge: 5.17 pC - Rise Time: 0.97 ns

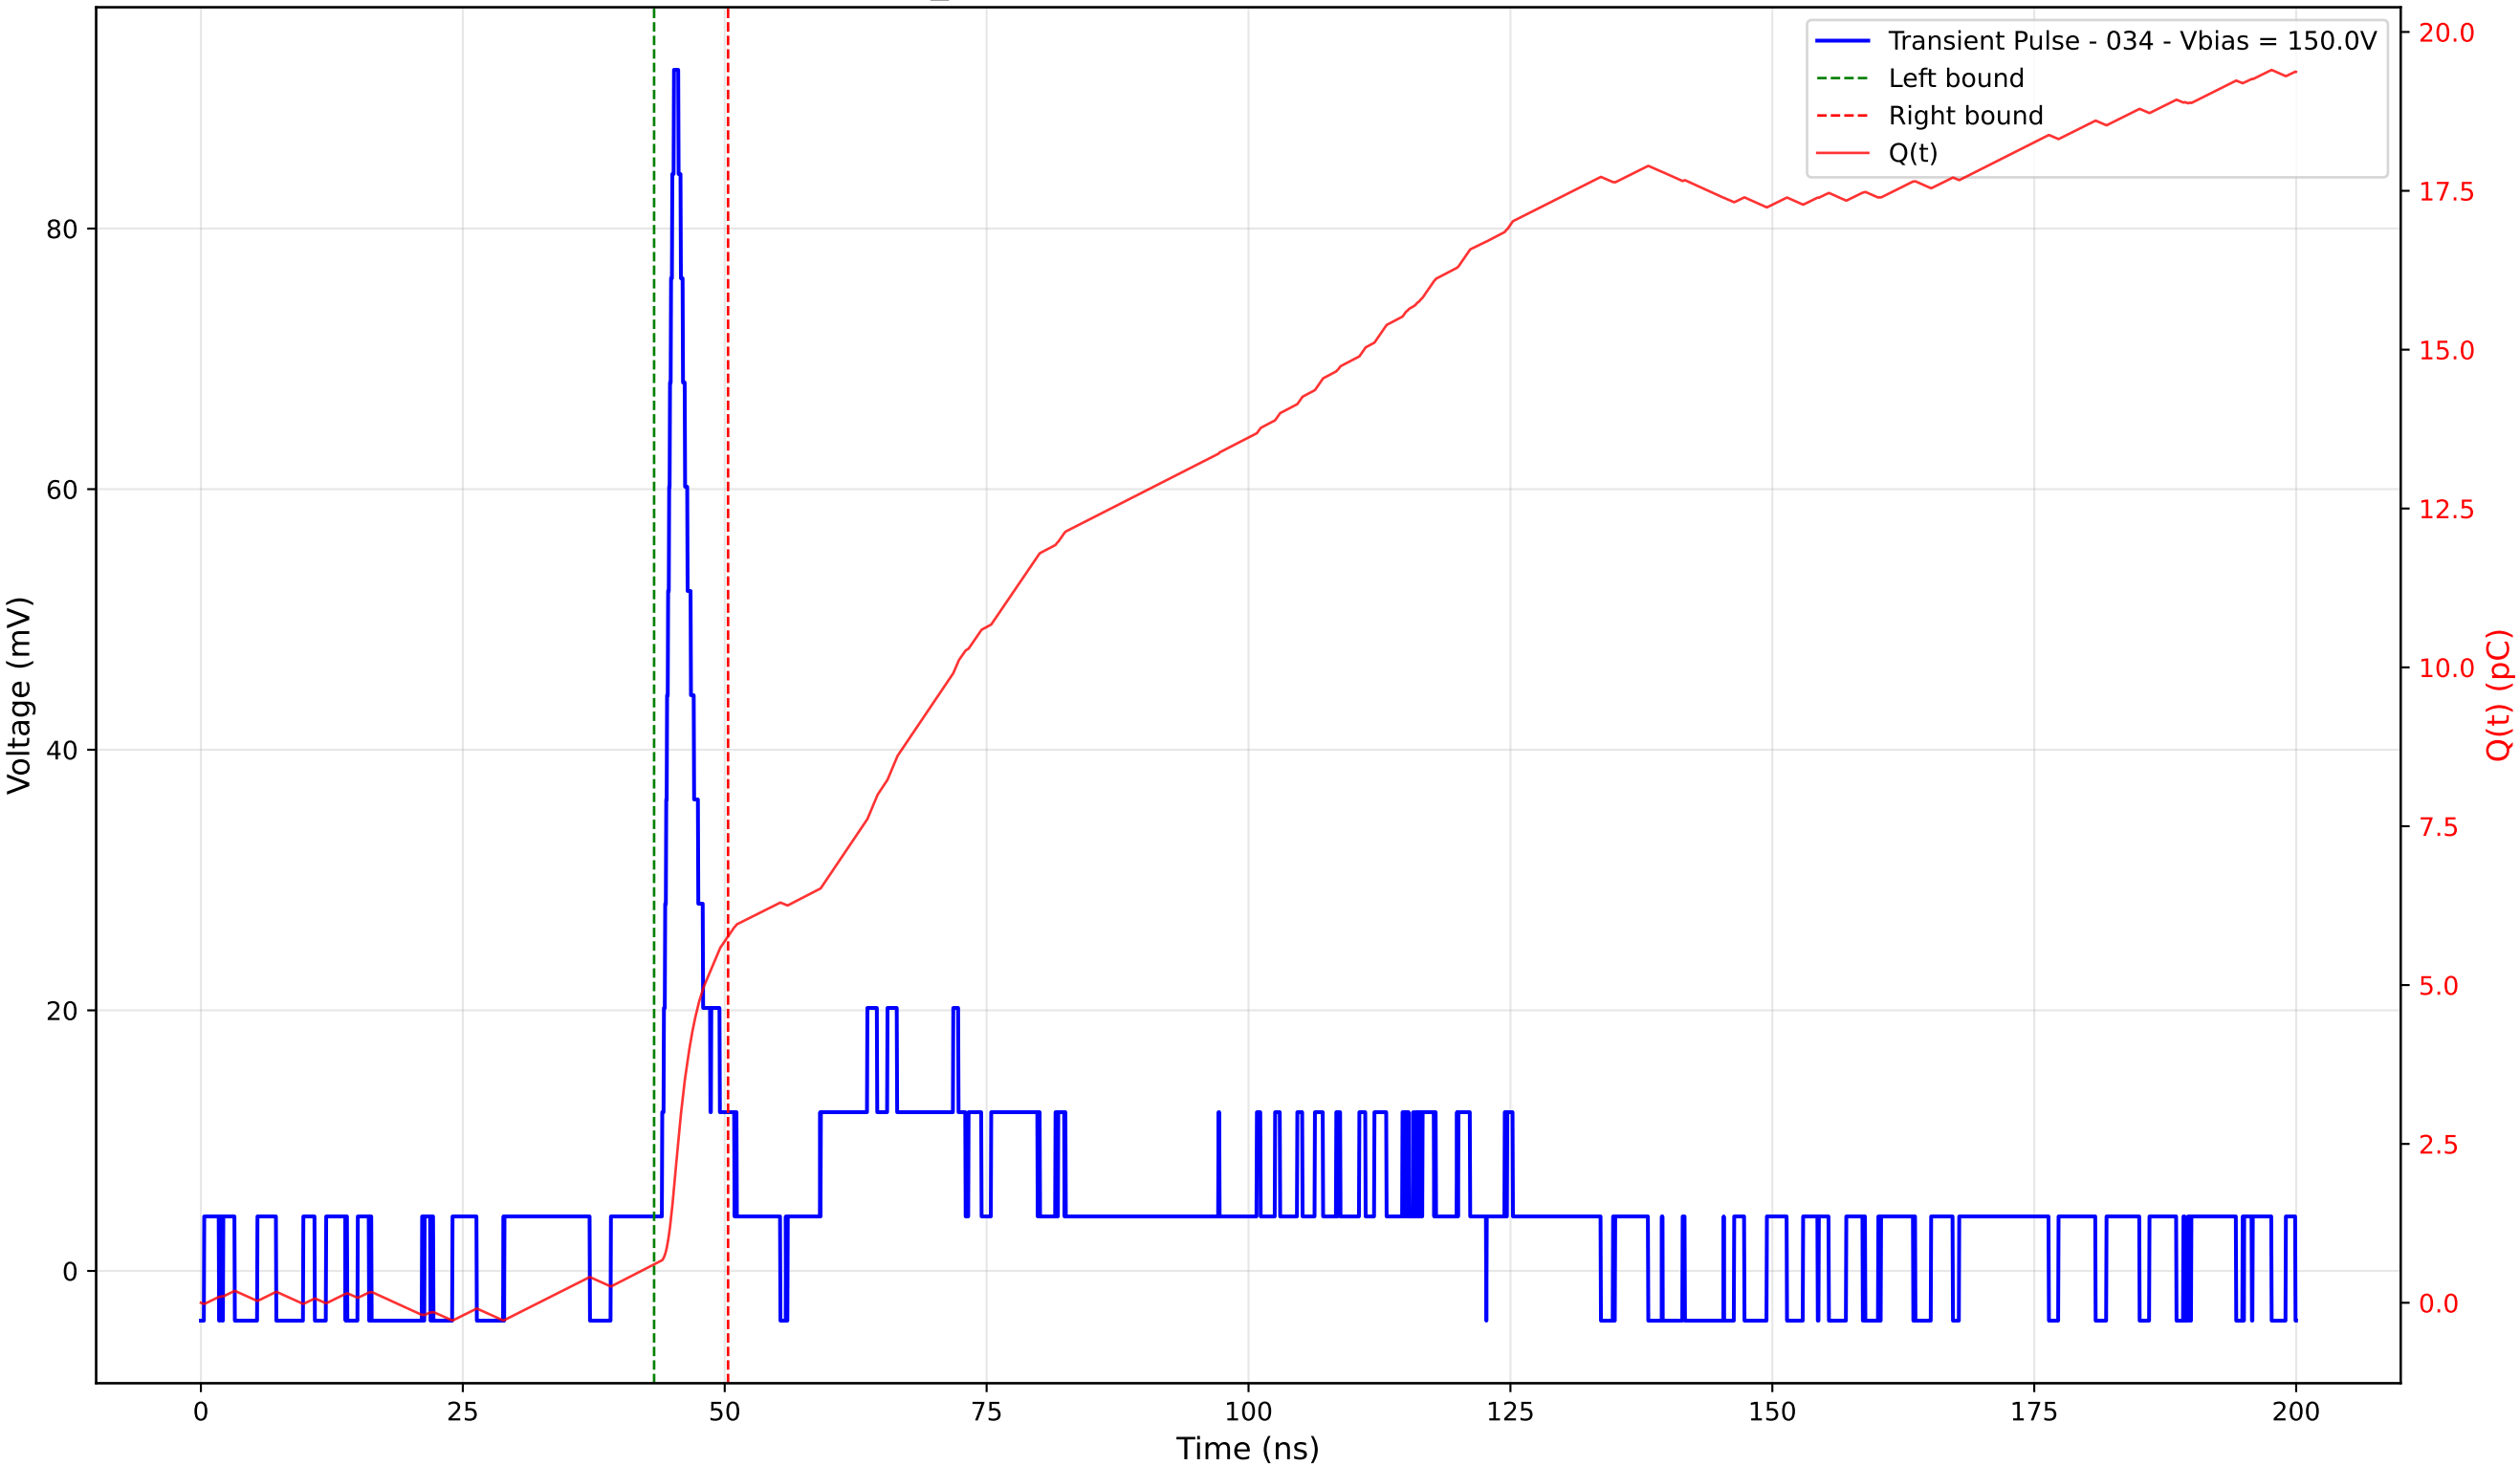


Transient Pulse - Sample: TD_4004 - Position: 55.0 μm - Charge: 8.03 pC - Rise Time: 0.99 ns

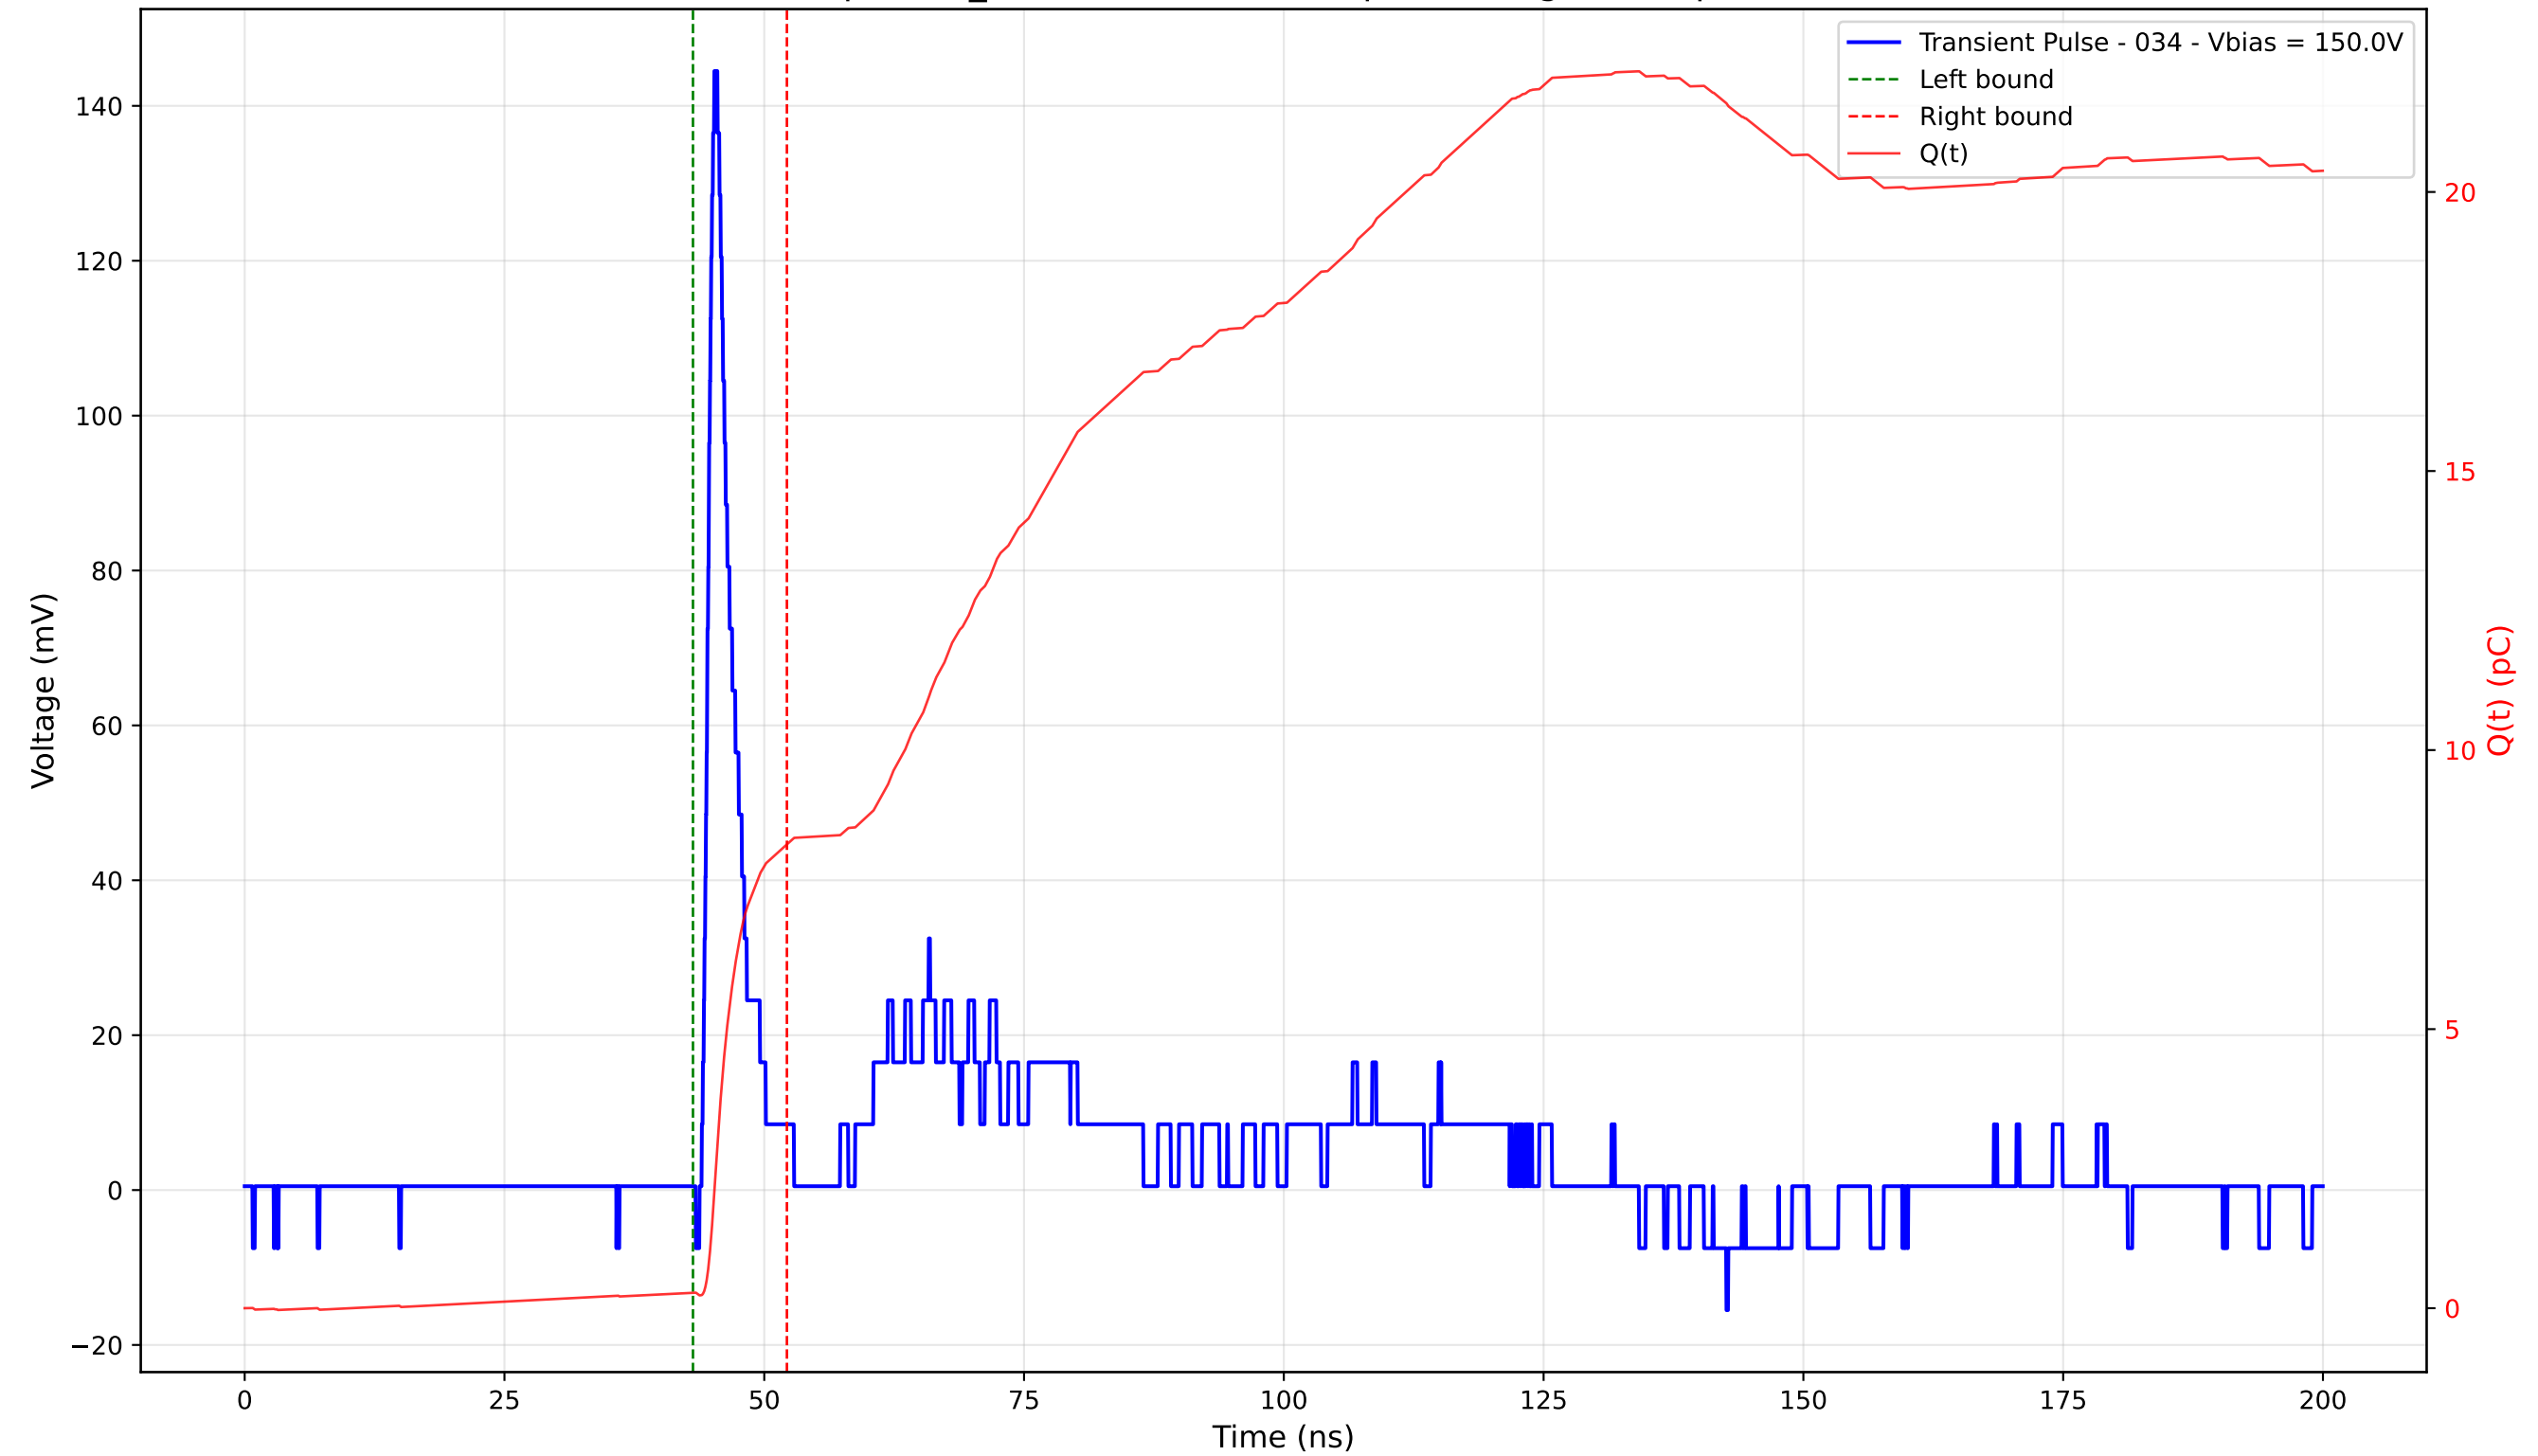


Transient Pulse - Sample: TD_4004 - Position: 60.0 μm - Charge: 12.66 pC - Rise Time: 0.95 ns

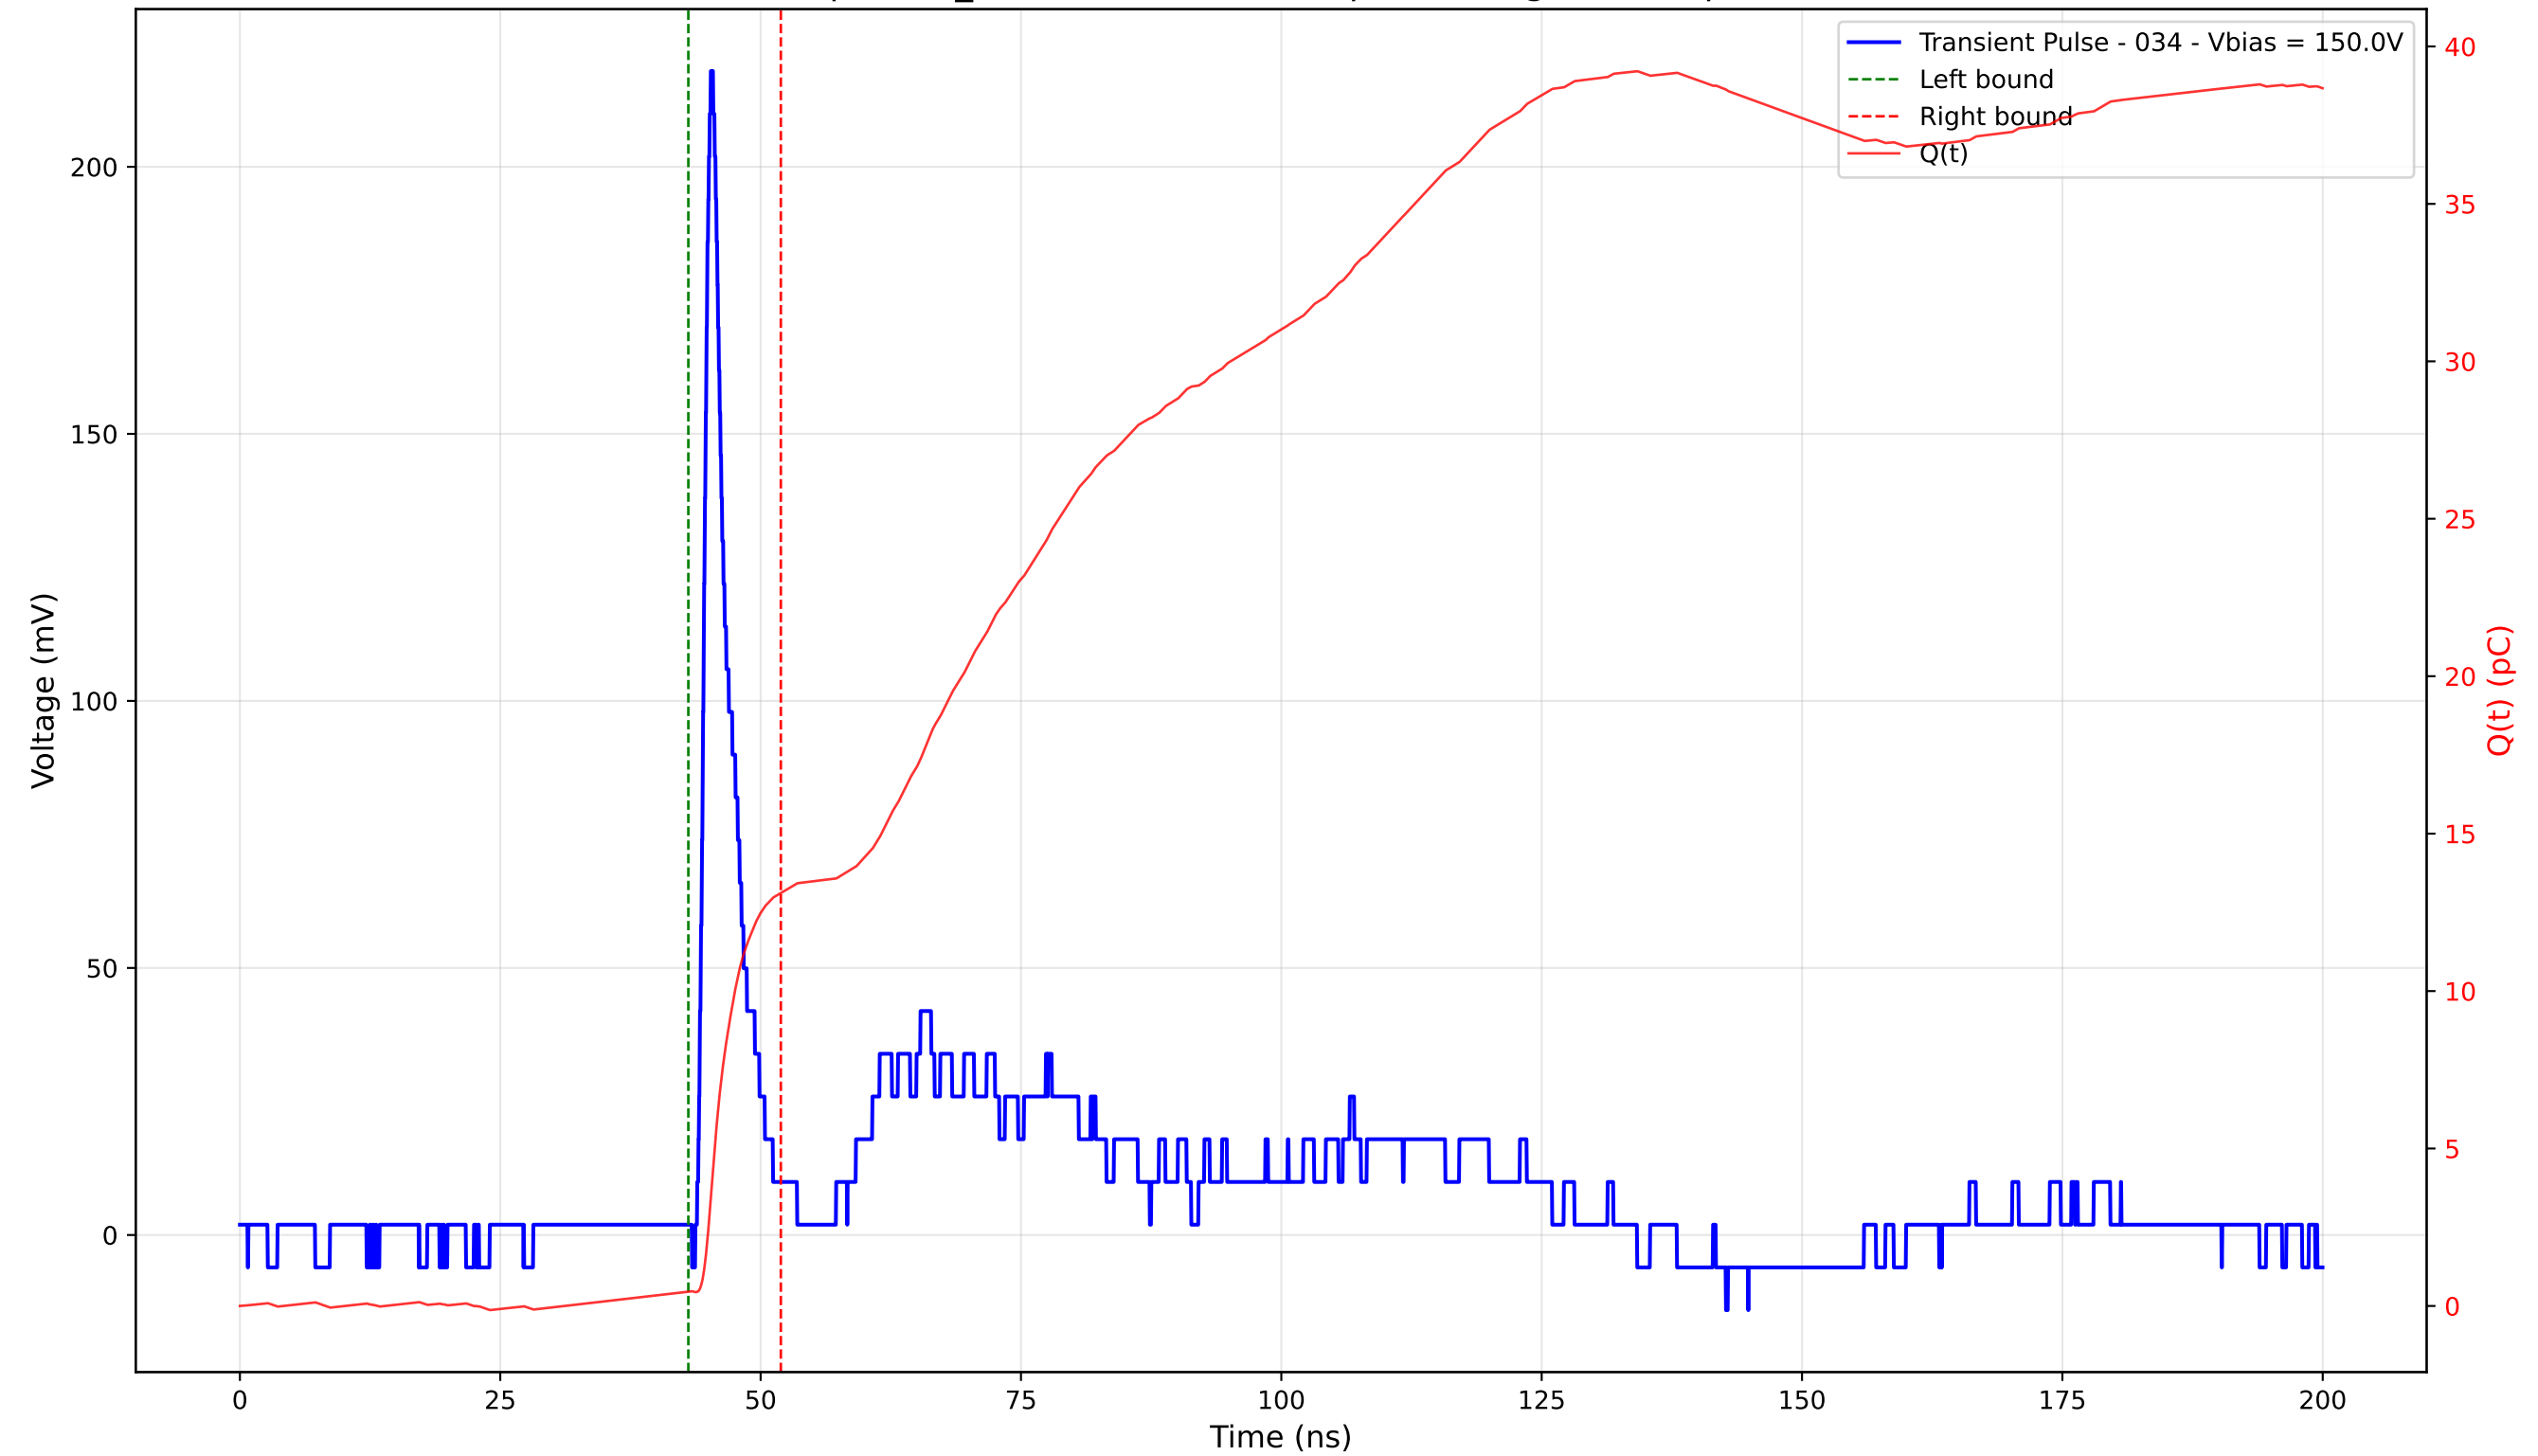


Transient Pulse - Sample: TD_4004 - Position: 65.0 μm - Charge: 20.08 pC - Rise Time: 0.90 ns

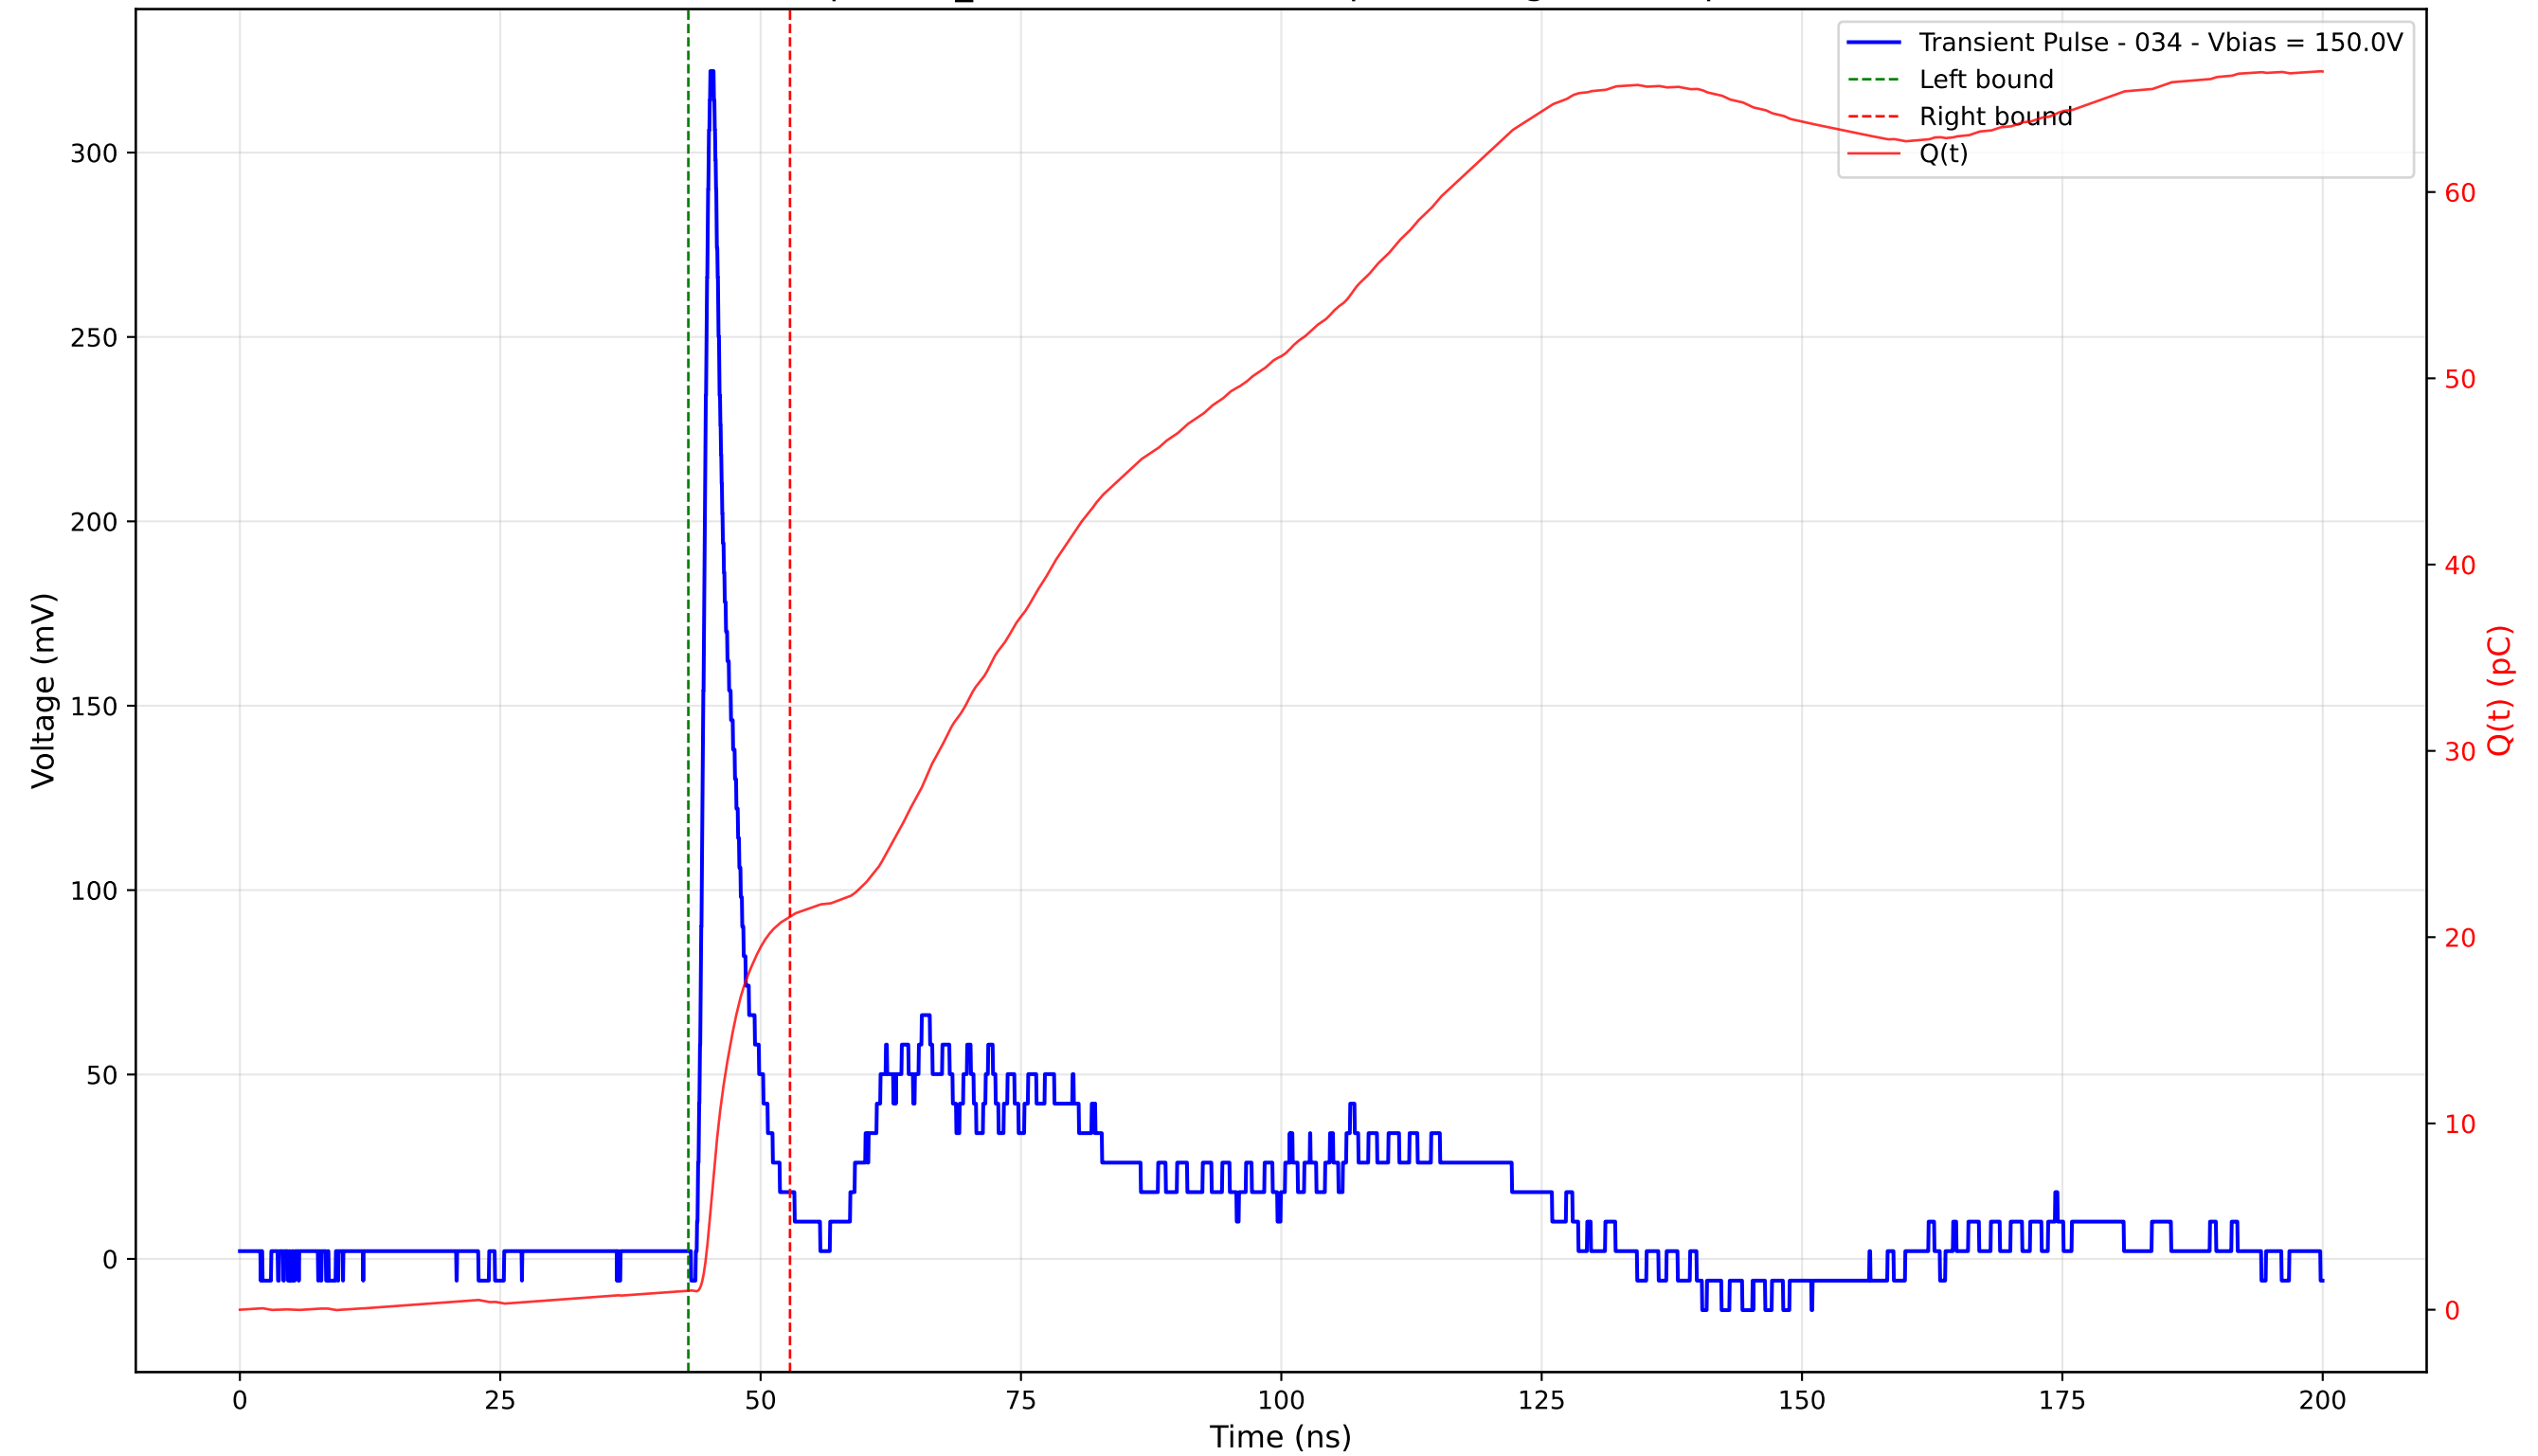


Transient Pulse - Sample: TD_4004 - Position: 70.0 μm - Charge: 26.77 pC - Rise Time: 0.93 ns

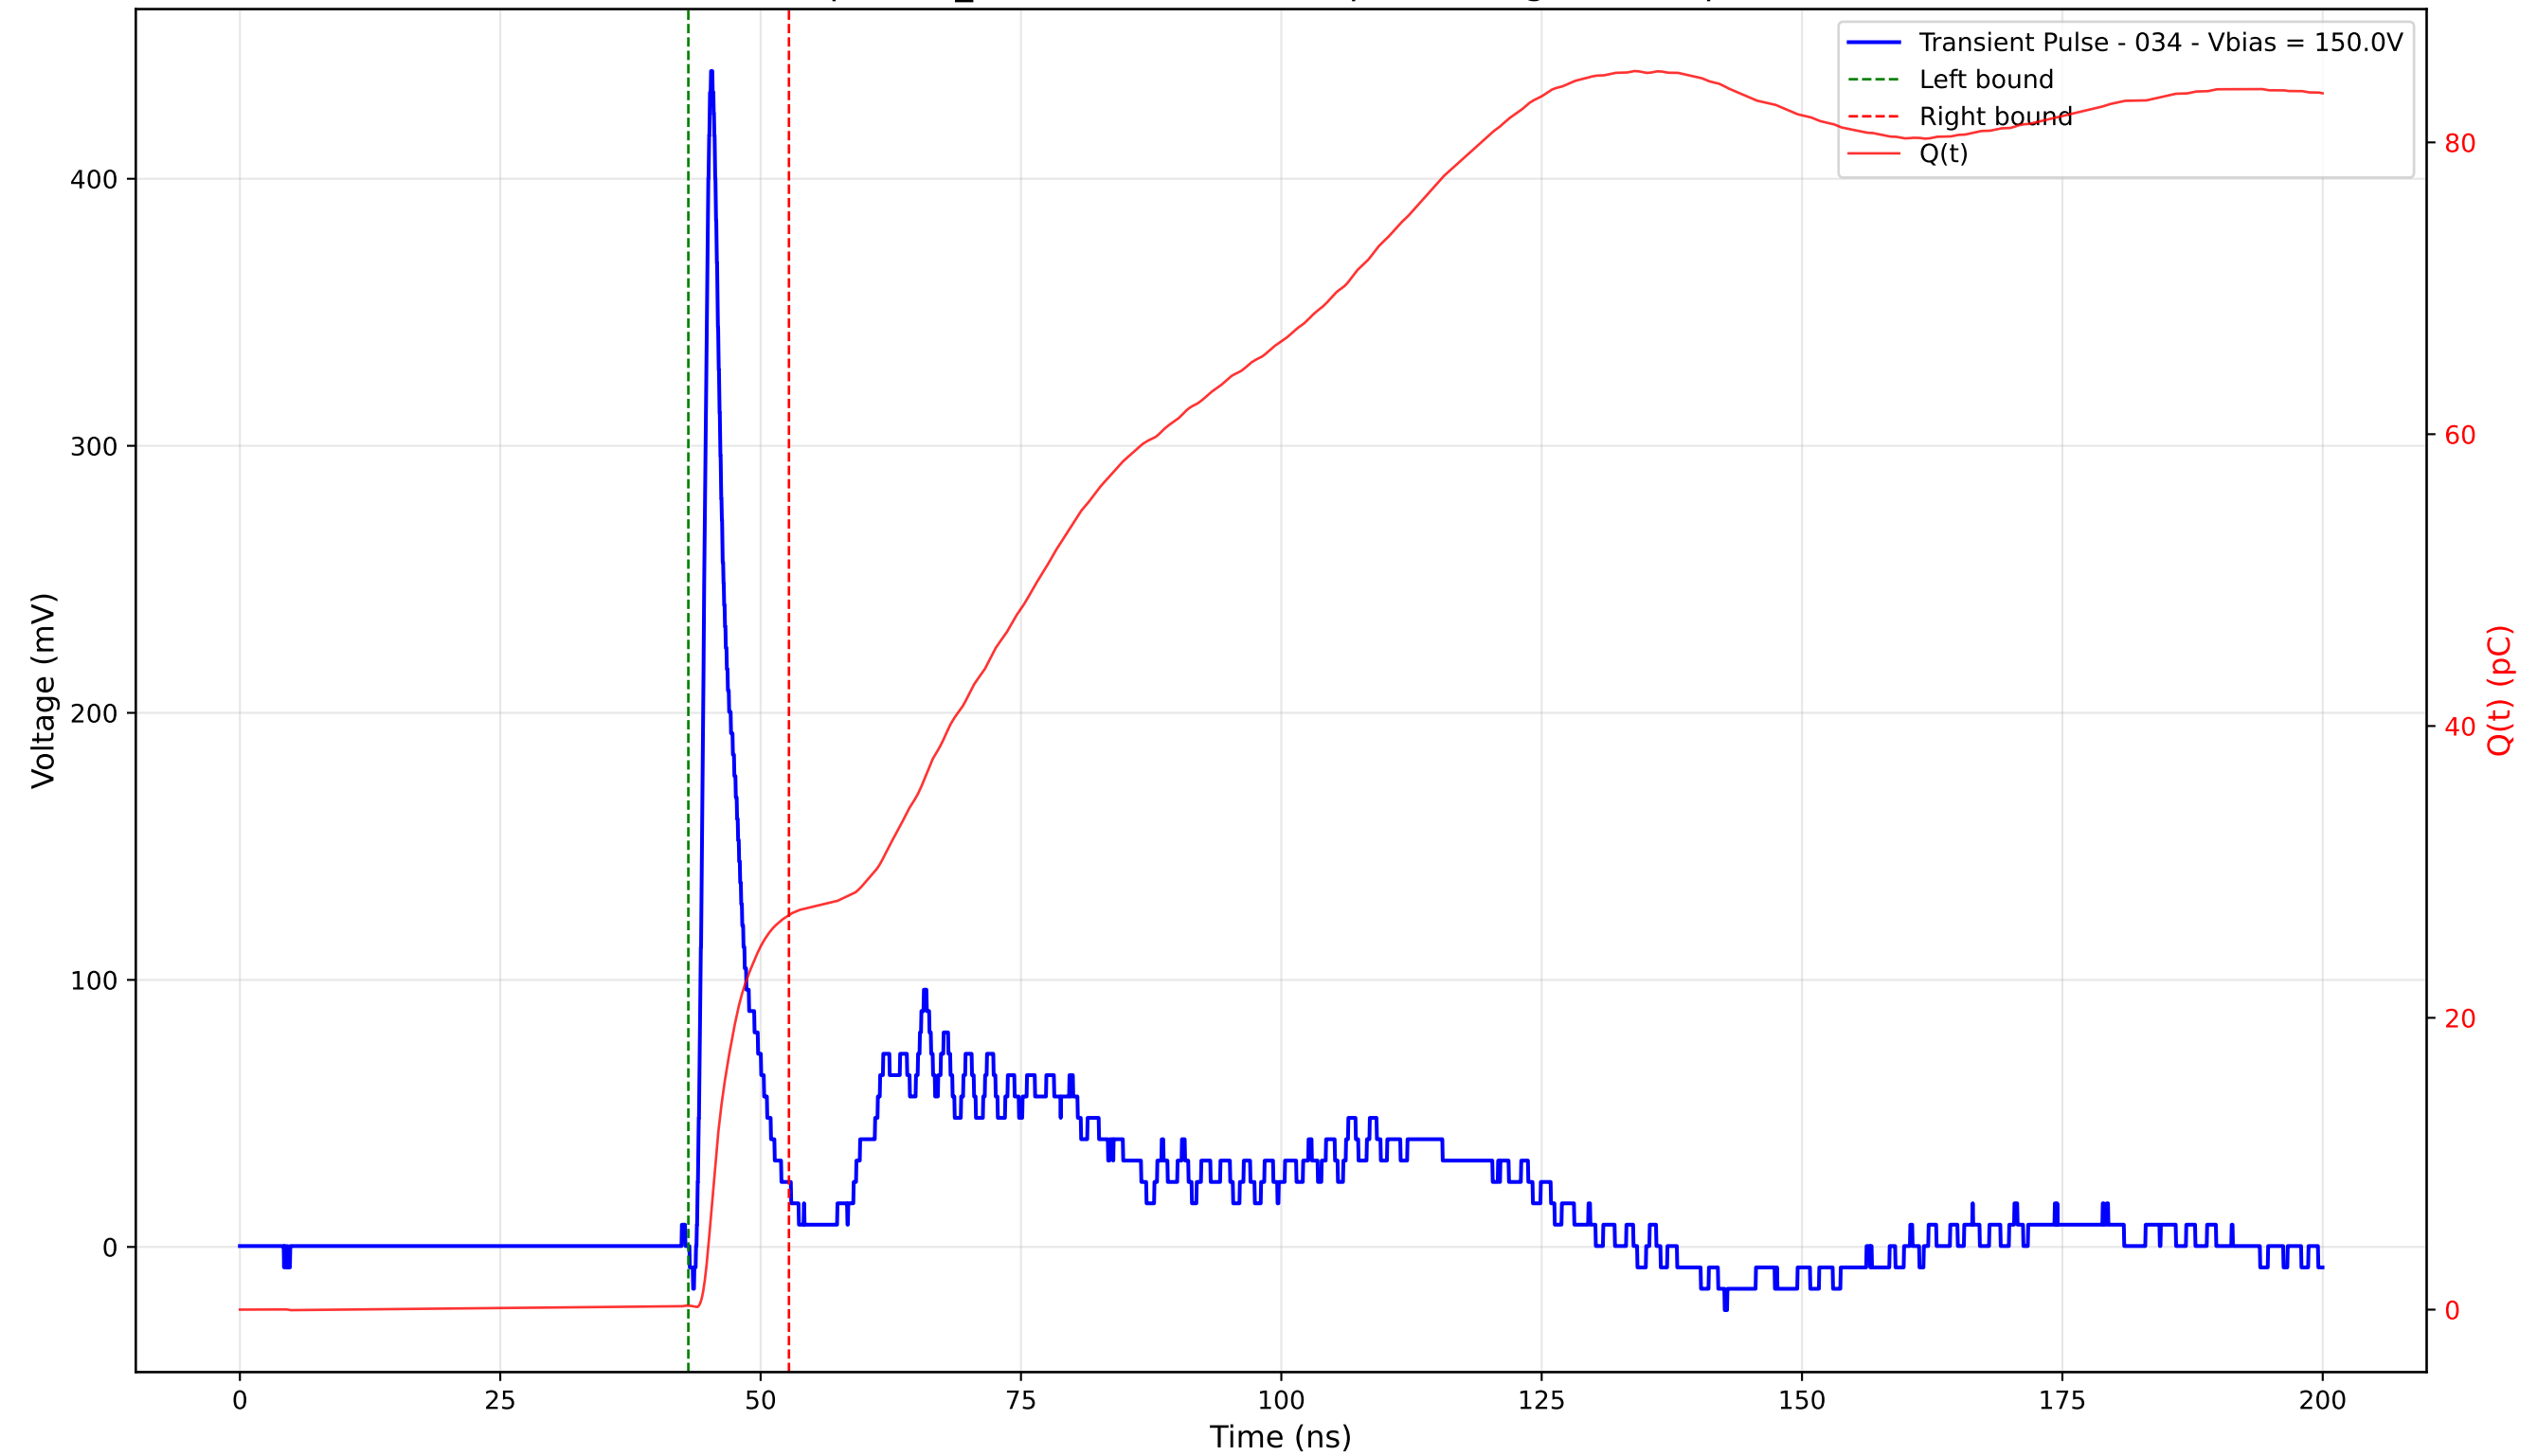


Transient Pulse - Sample: TD_4004 - Position: 75.0 μm - Charge: 32.40 pC - Rise Time: 0.89 ns

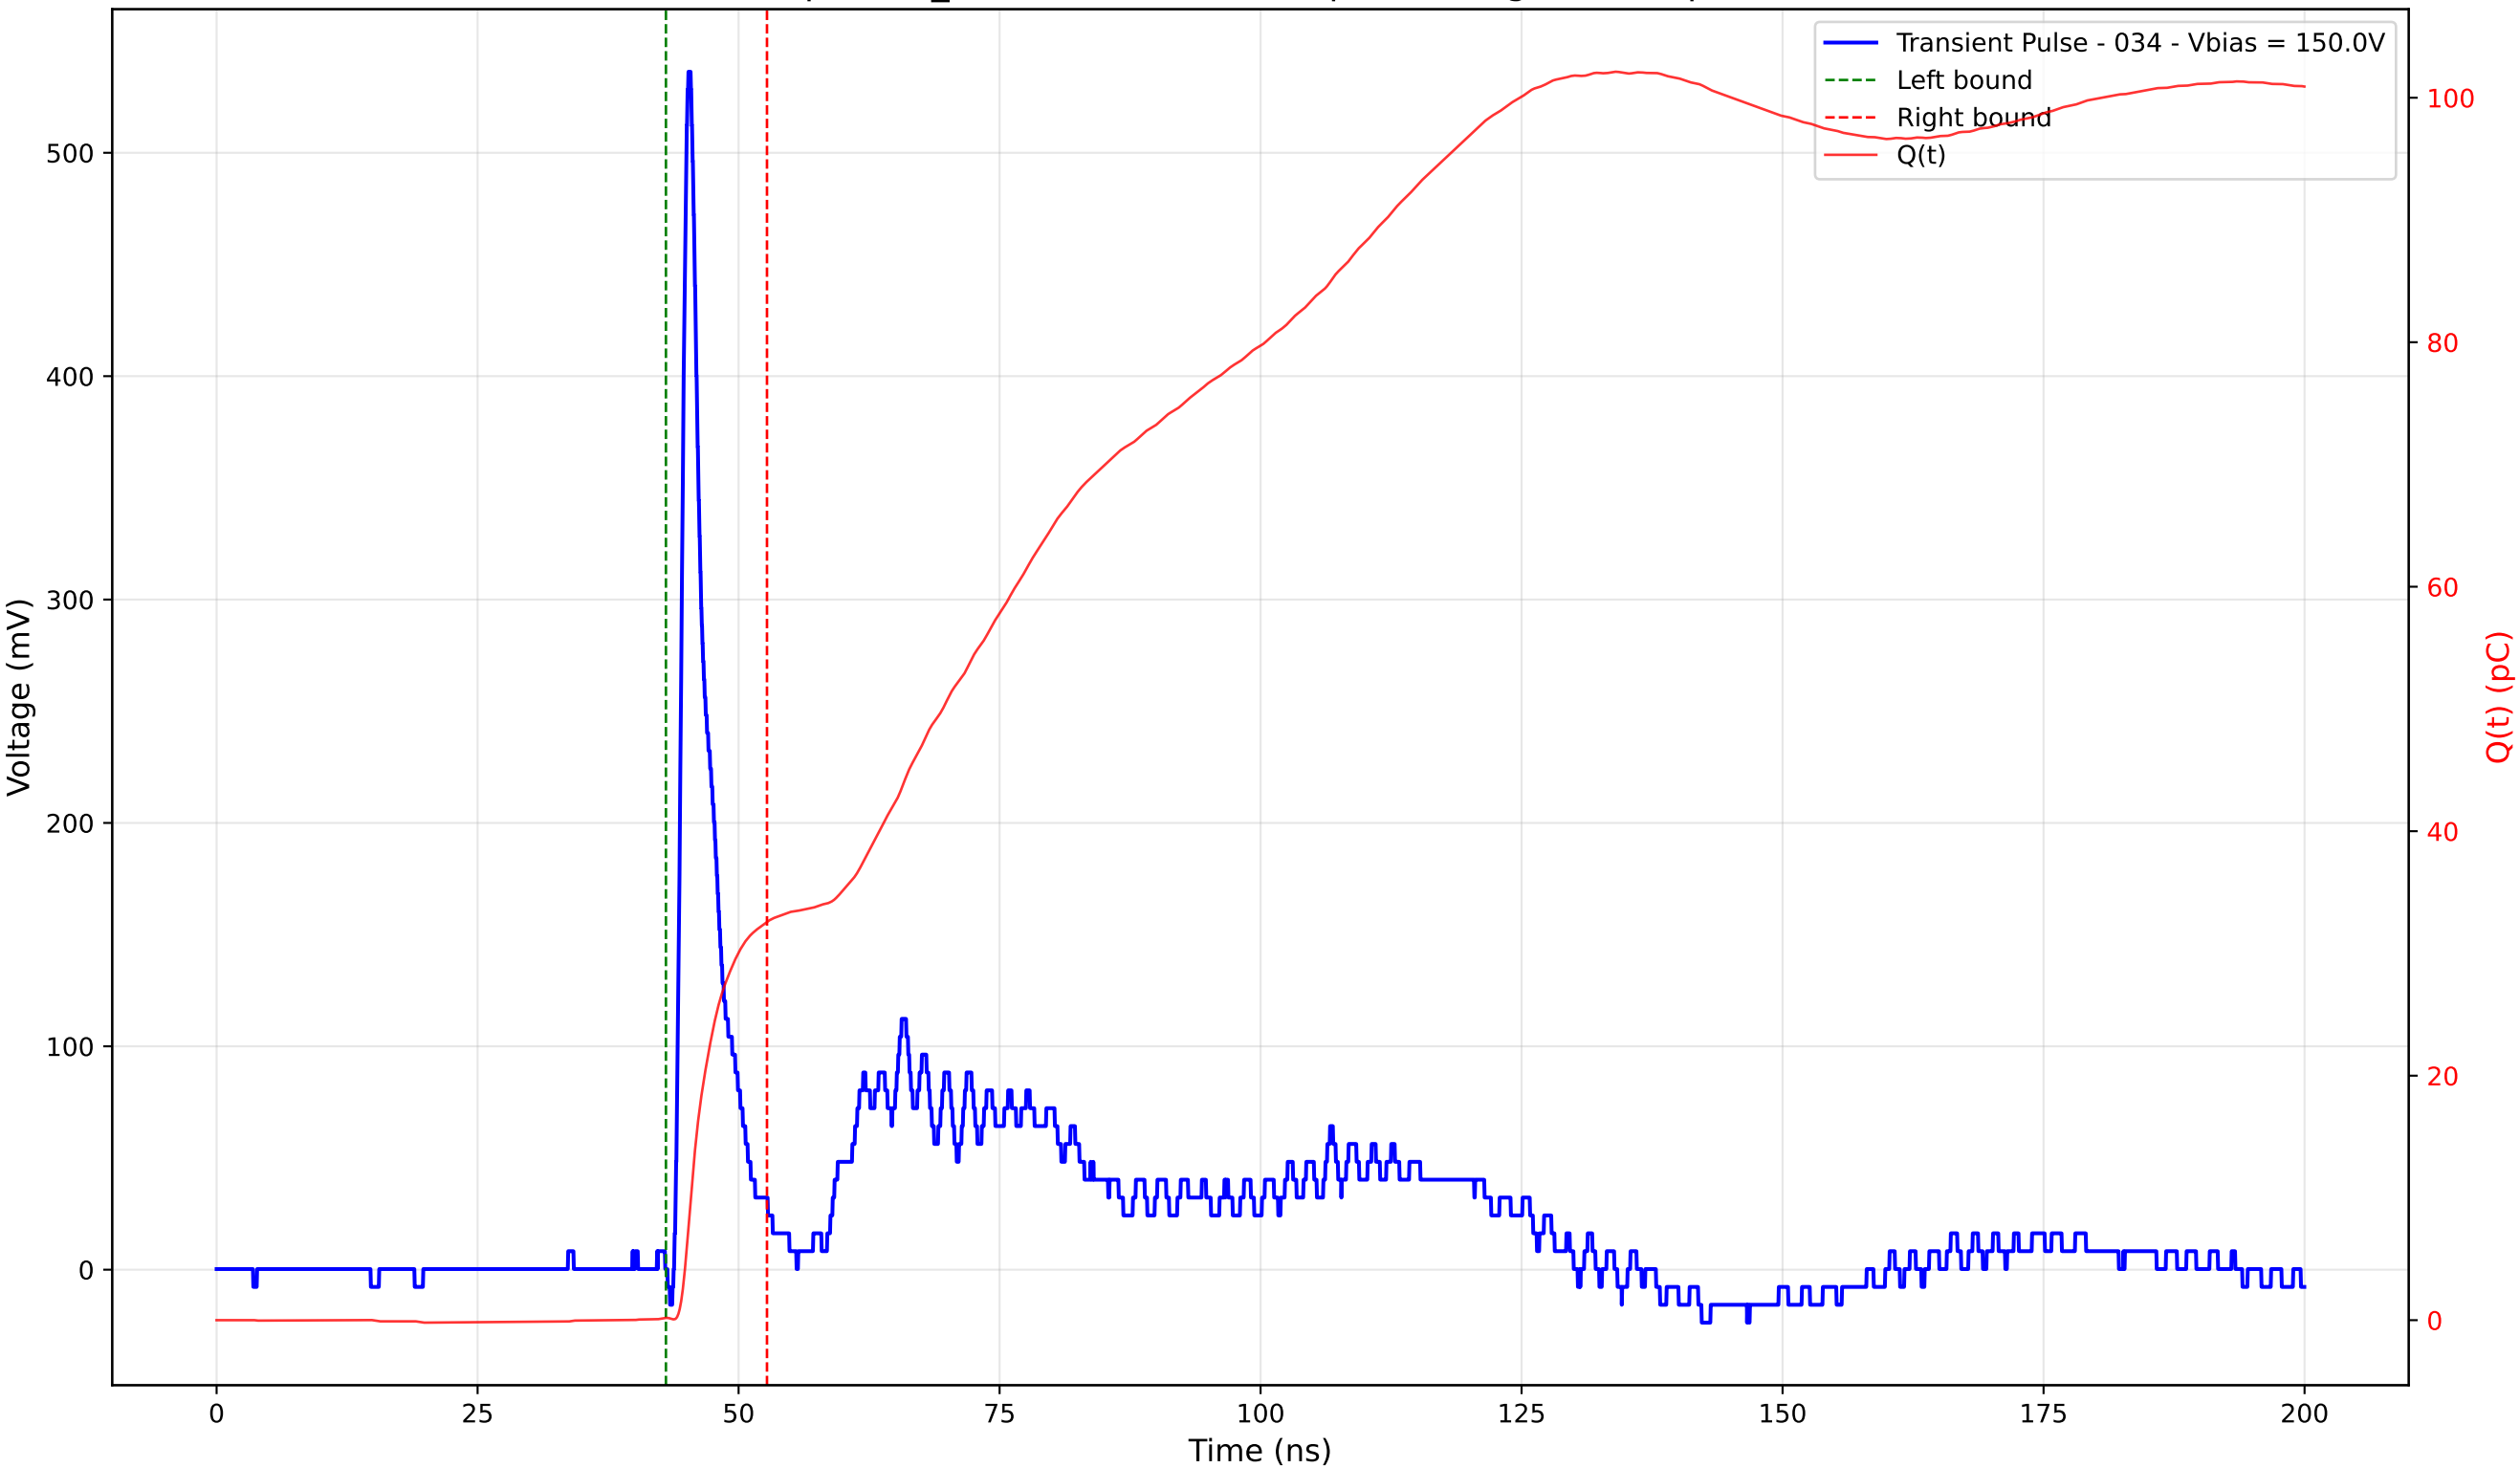


Transient Pulse - Sample: TD_4004 - Position: 80.0 μm - Charge: 36.97 pC - Rise Time: 0.92 ns

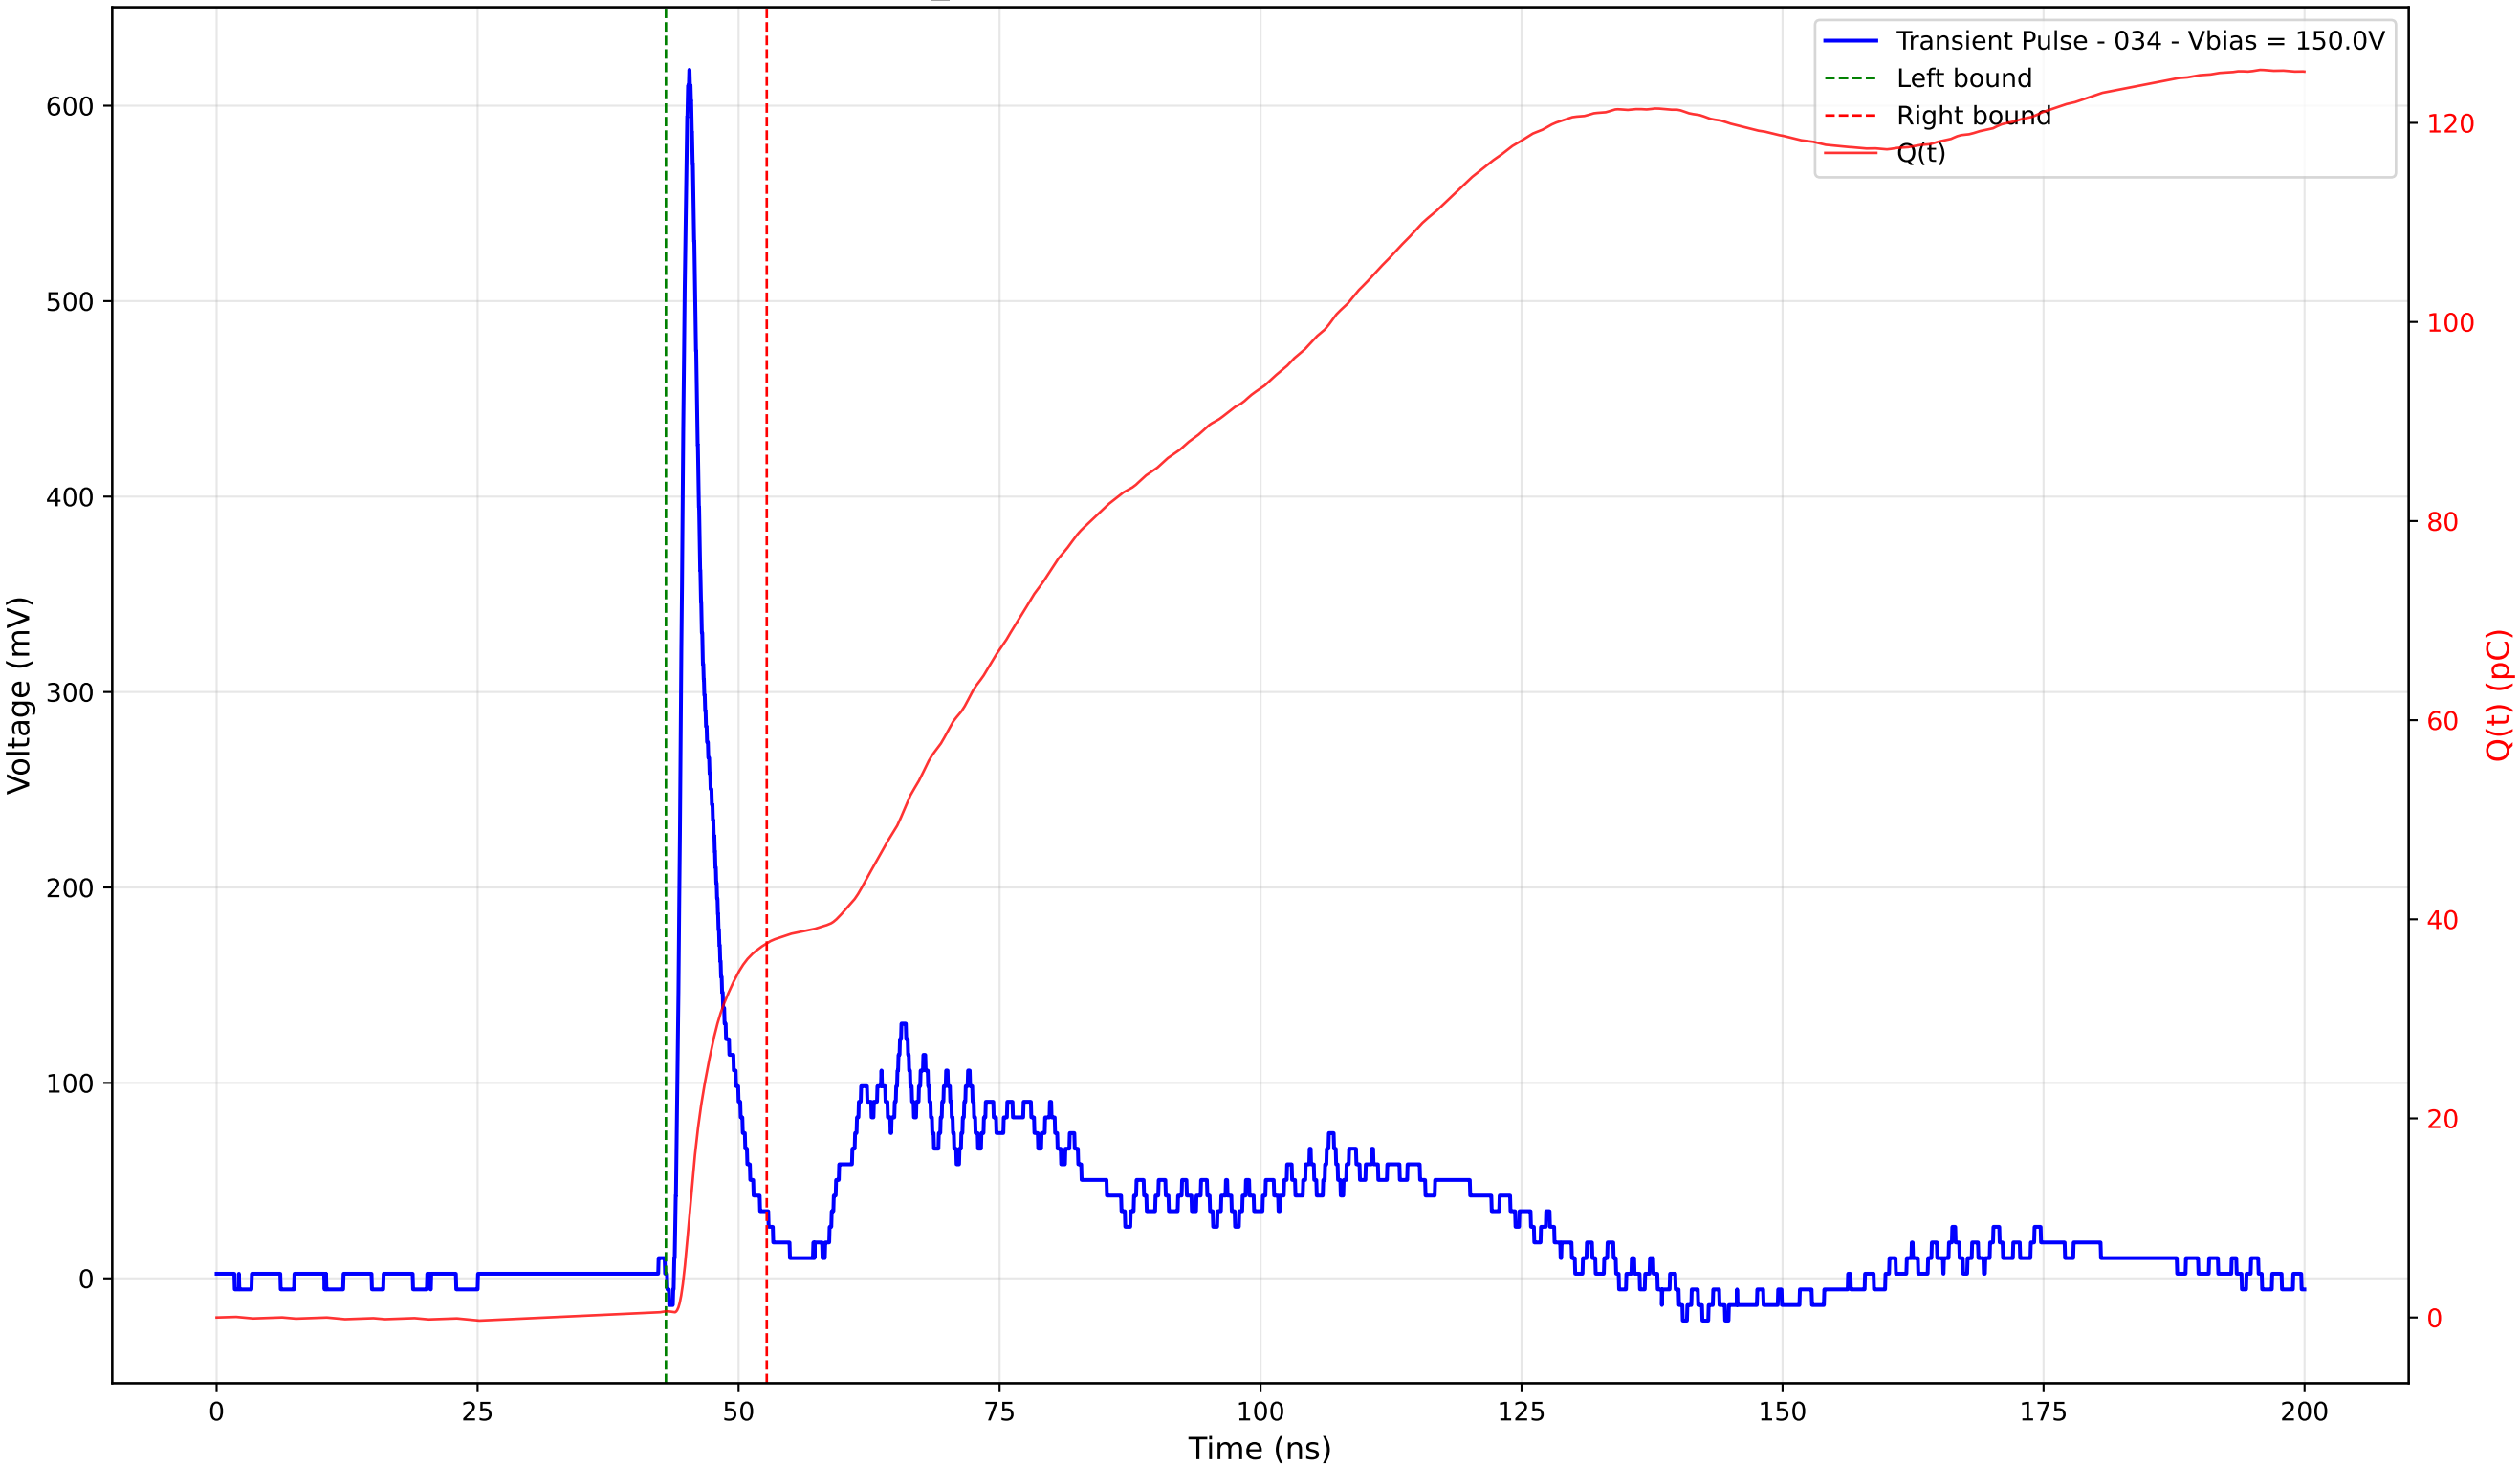


Transient Pulse - Sample: TD_4004 - Position: 85.0 μm - Charge: 39.97 pC - Rise Time: 0.89 ns

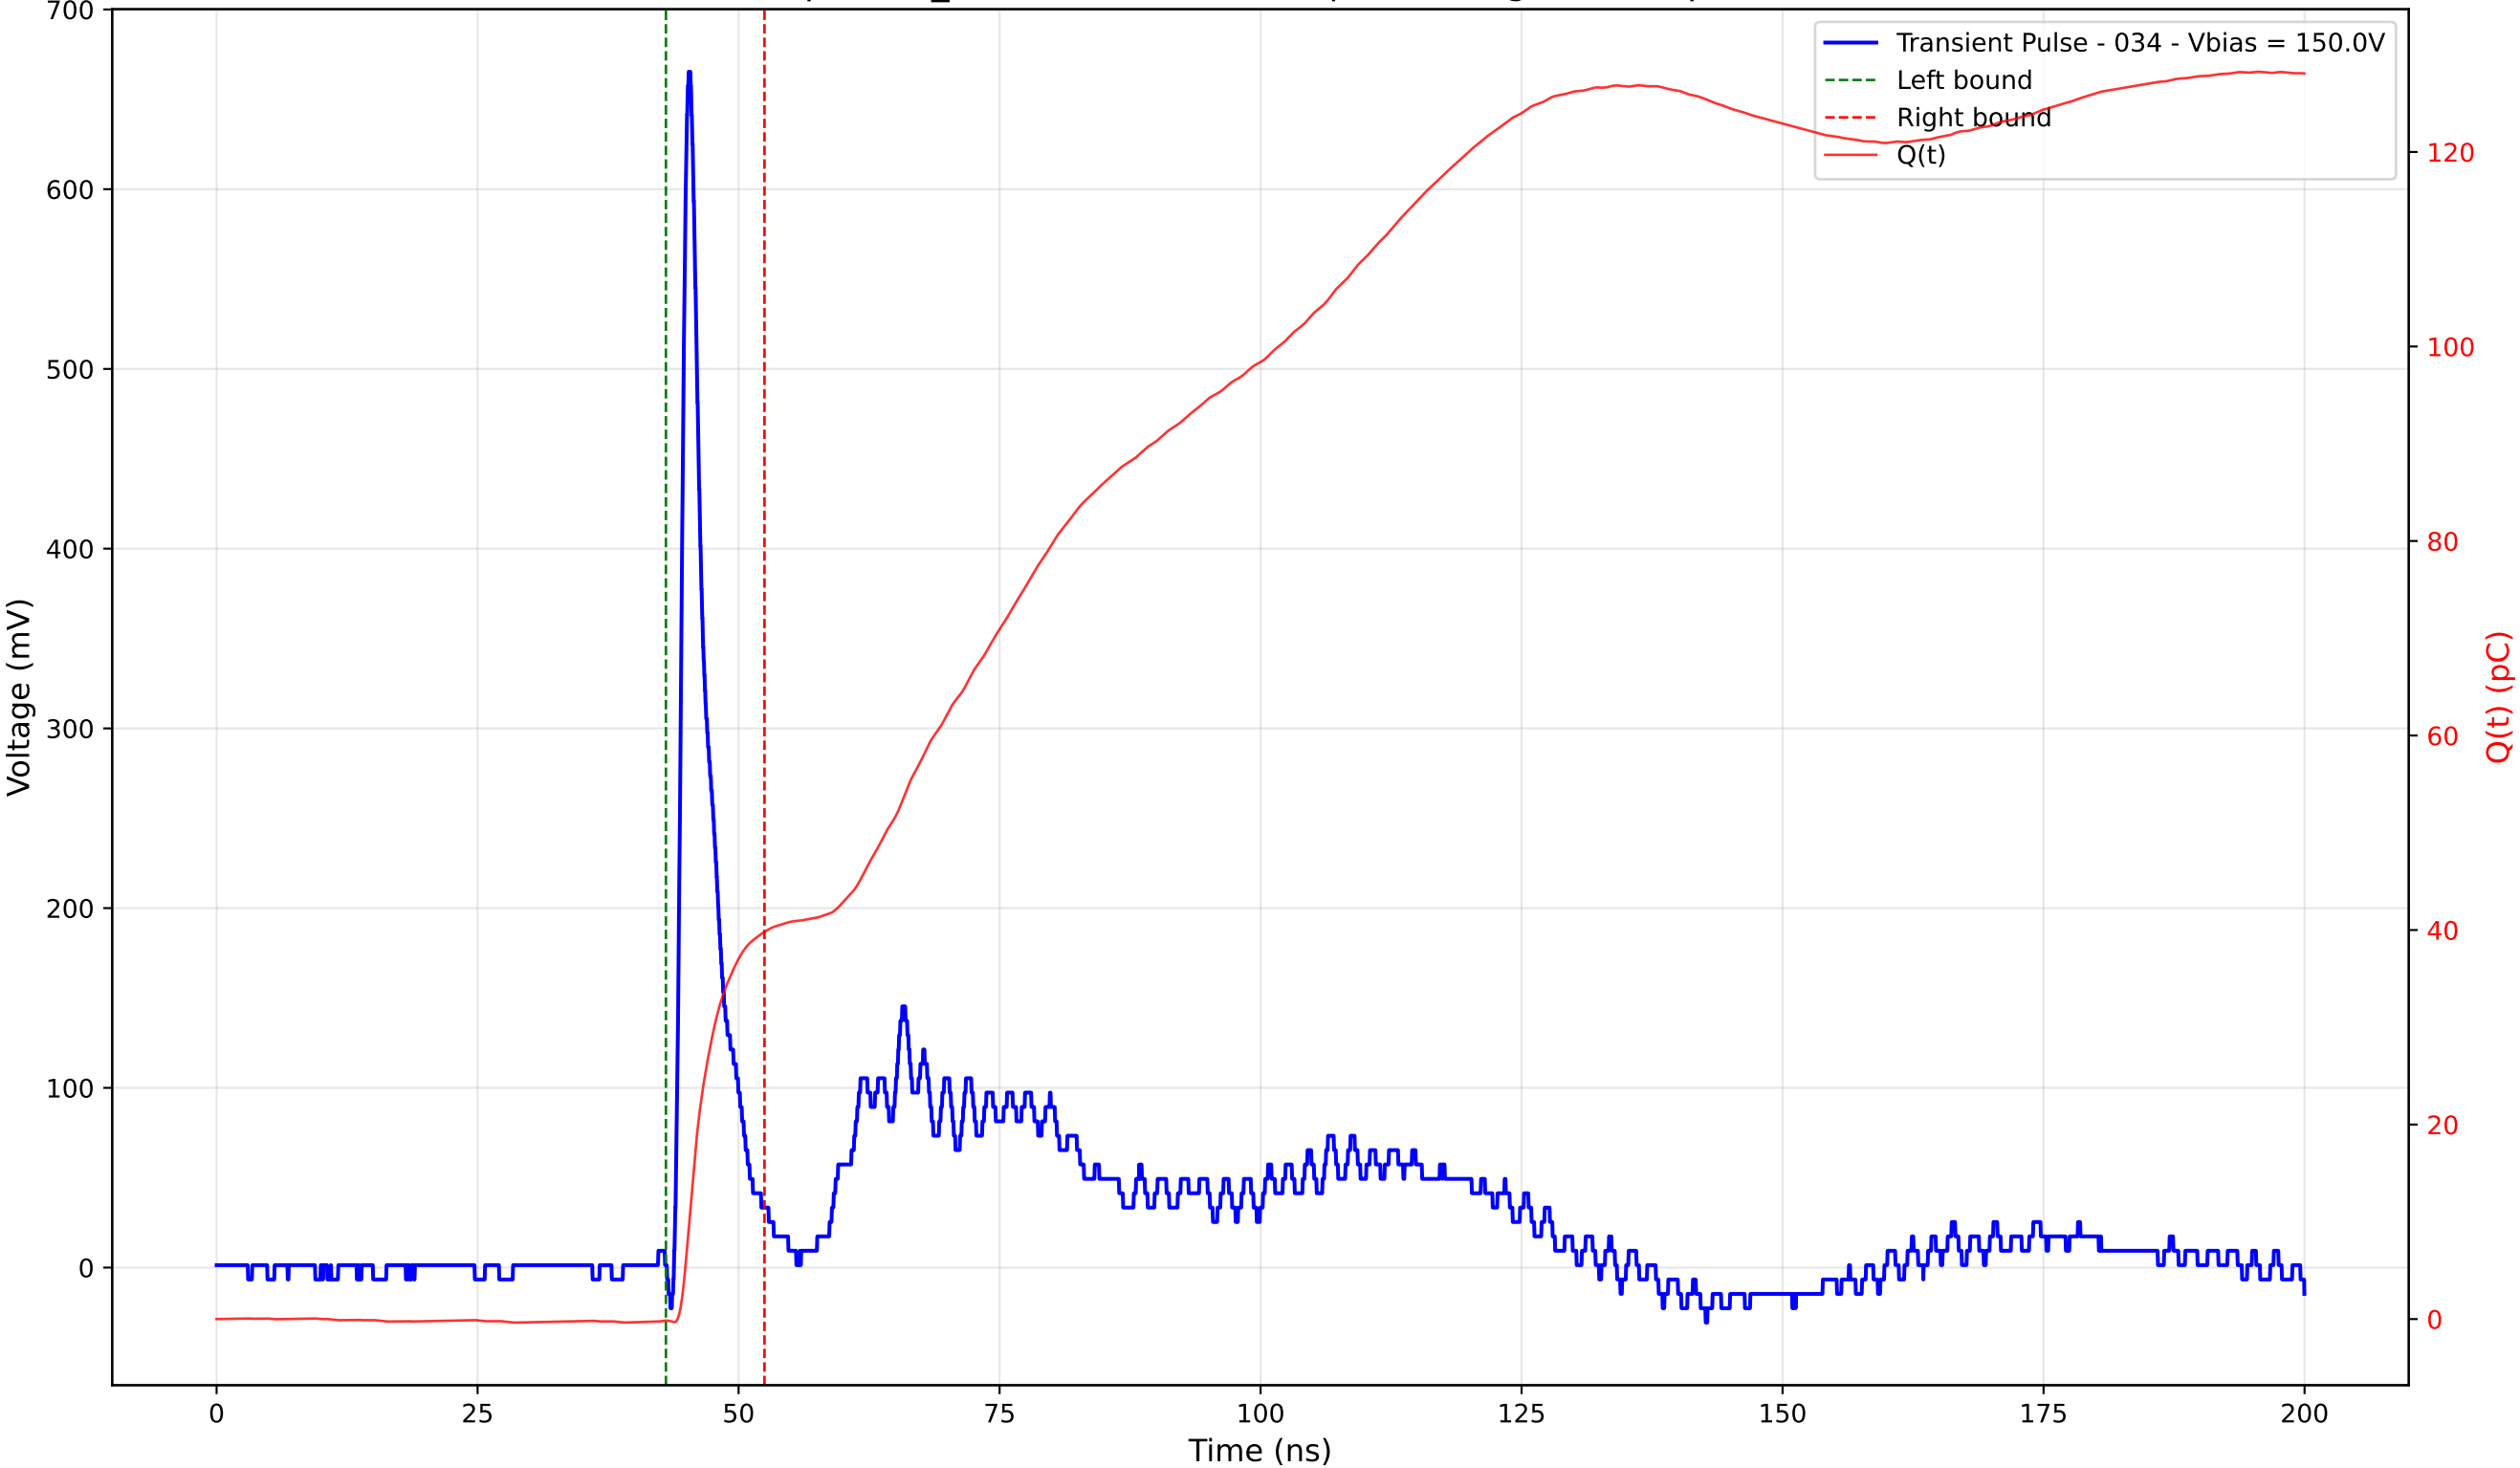


Transient Pulse - Sample: TD_4004 - Position: 90.0 μm - Charge: 44.01 pC - Rise Time: 0.91 ns

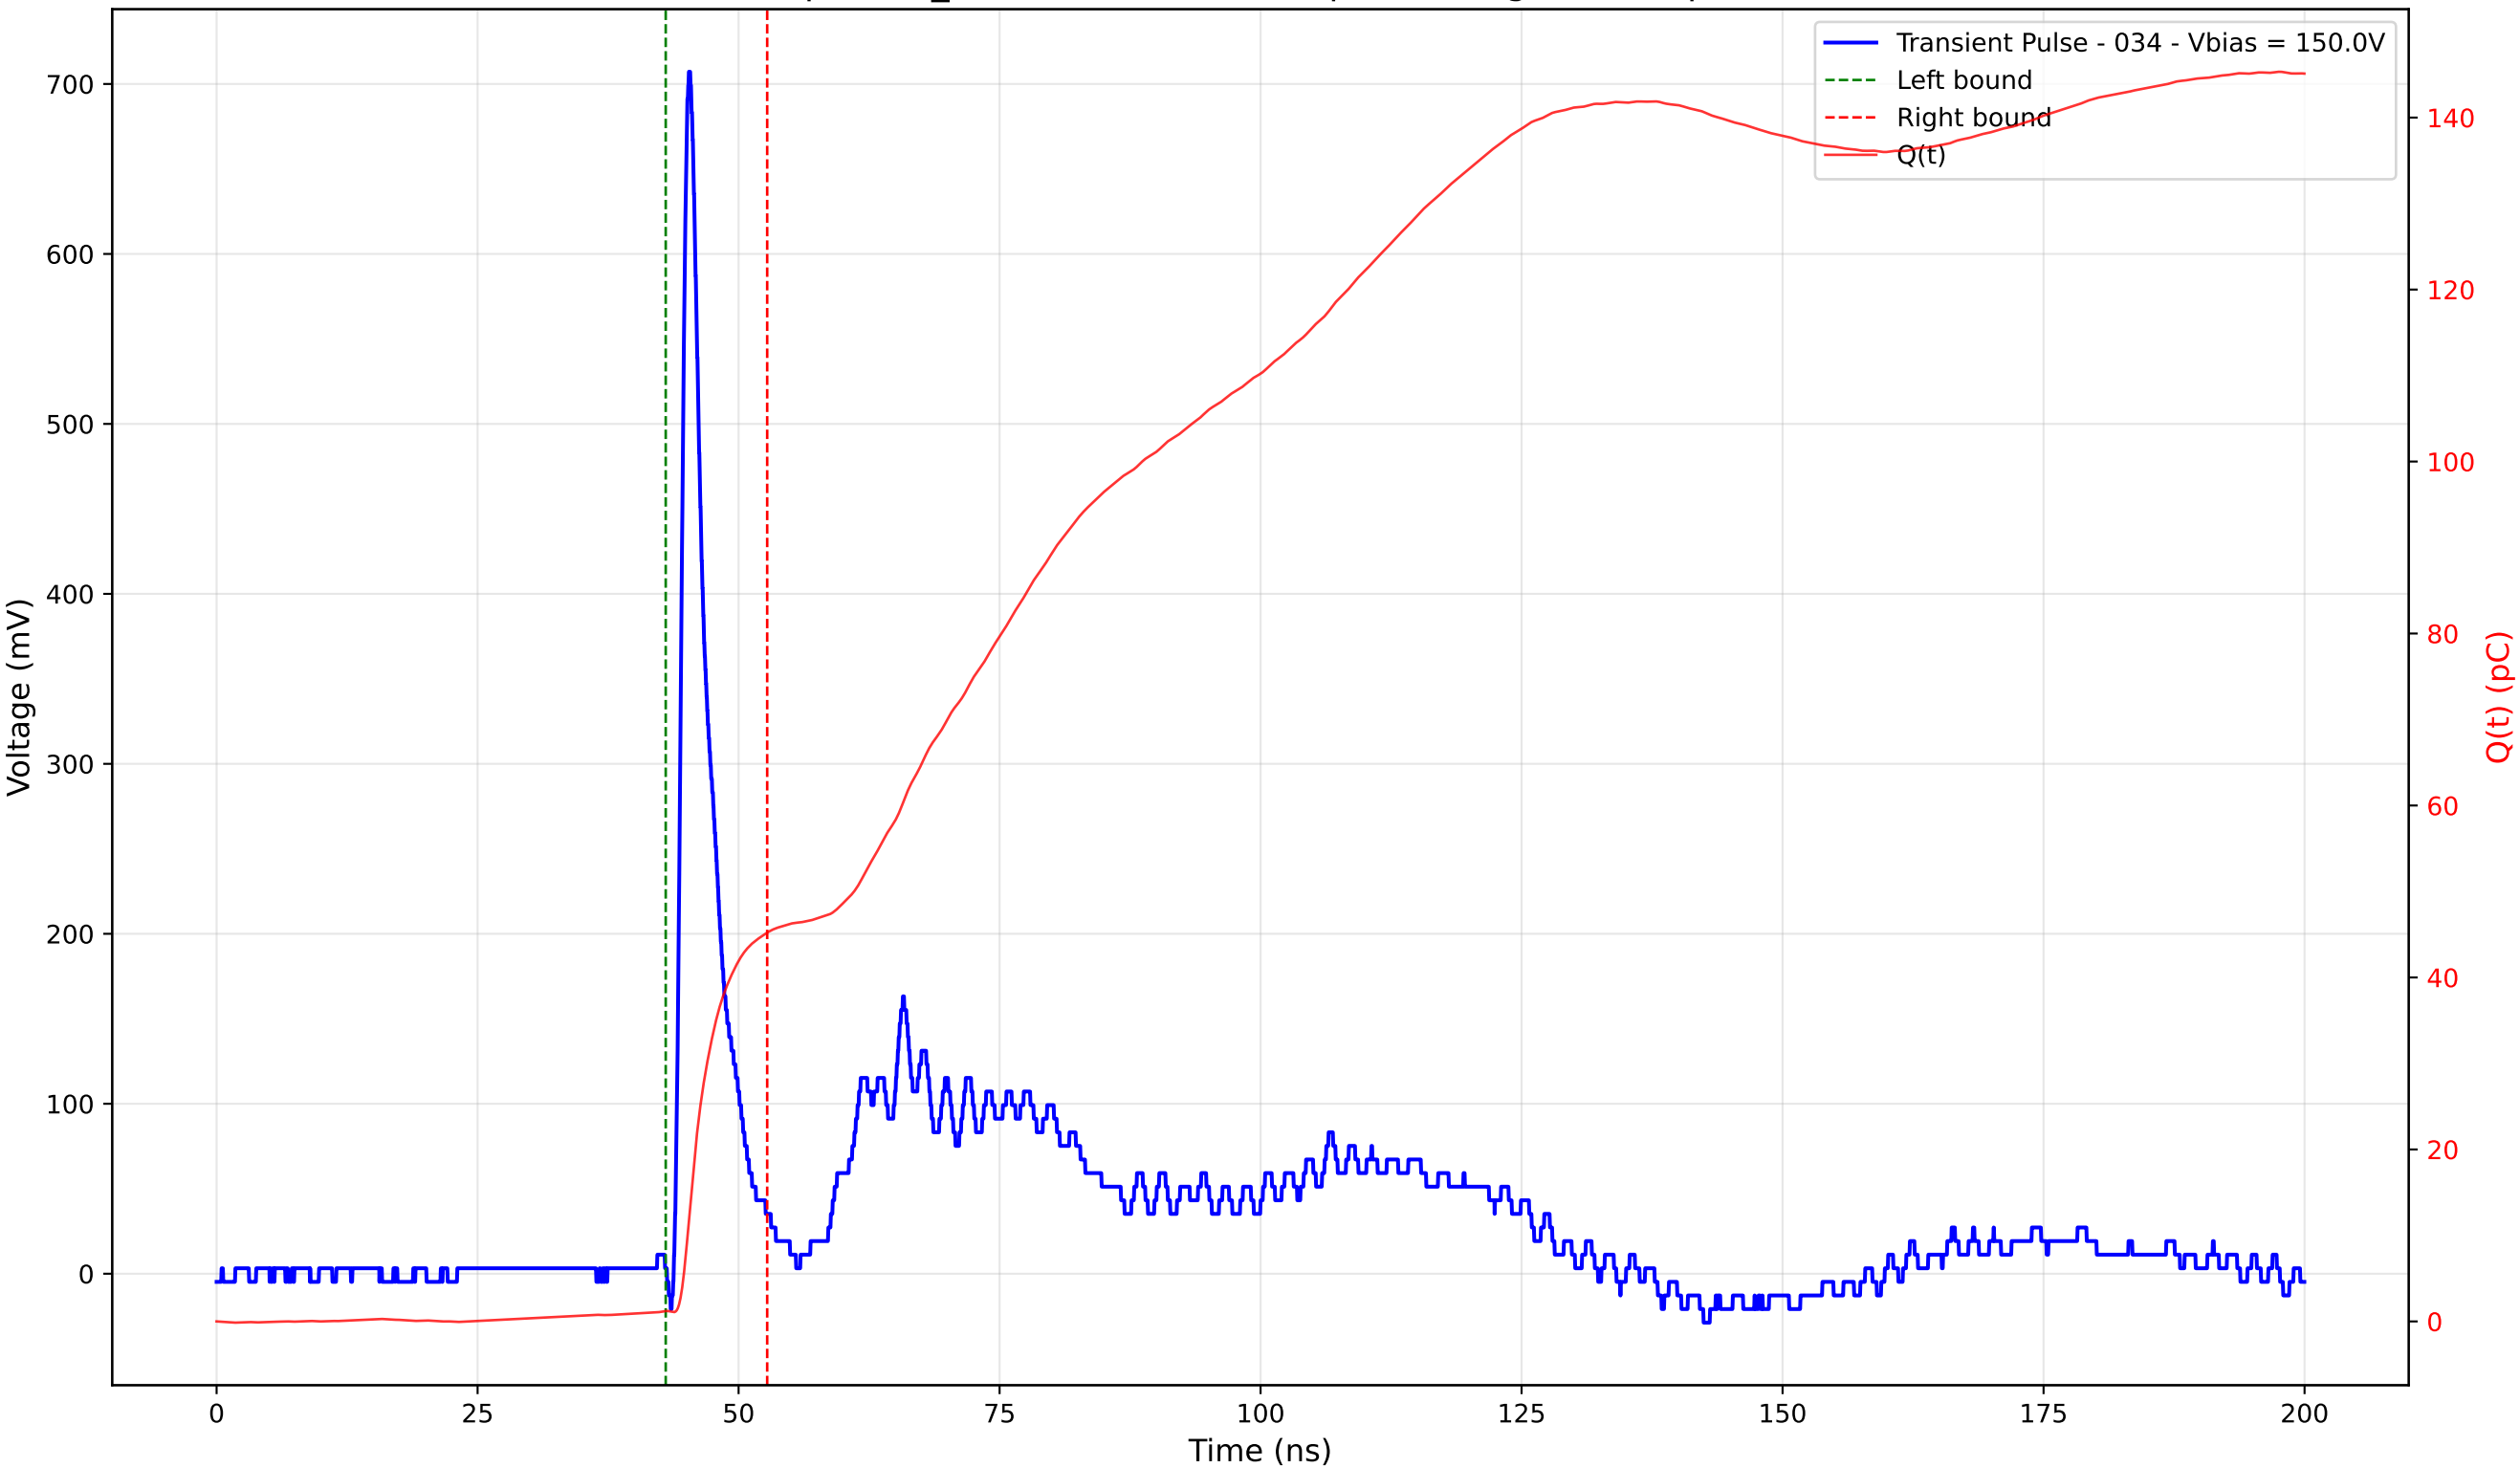


Transient Pulse - Sample: TD_4004 - Position: 95.0 μm - Charge: 47.12 pC - Rise Time: 0.91 ns

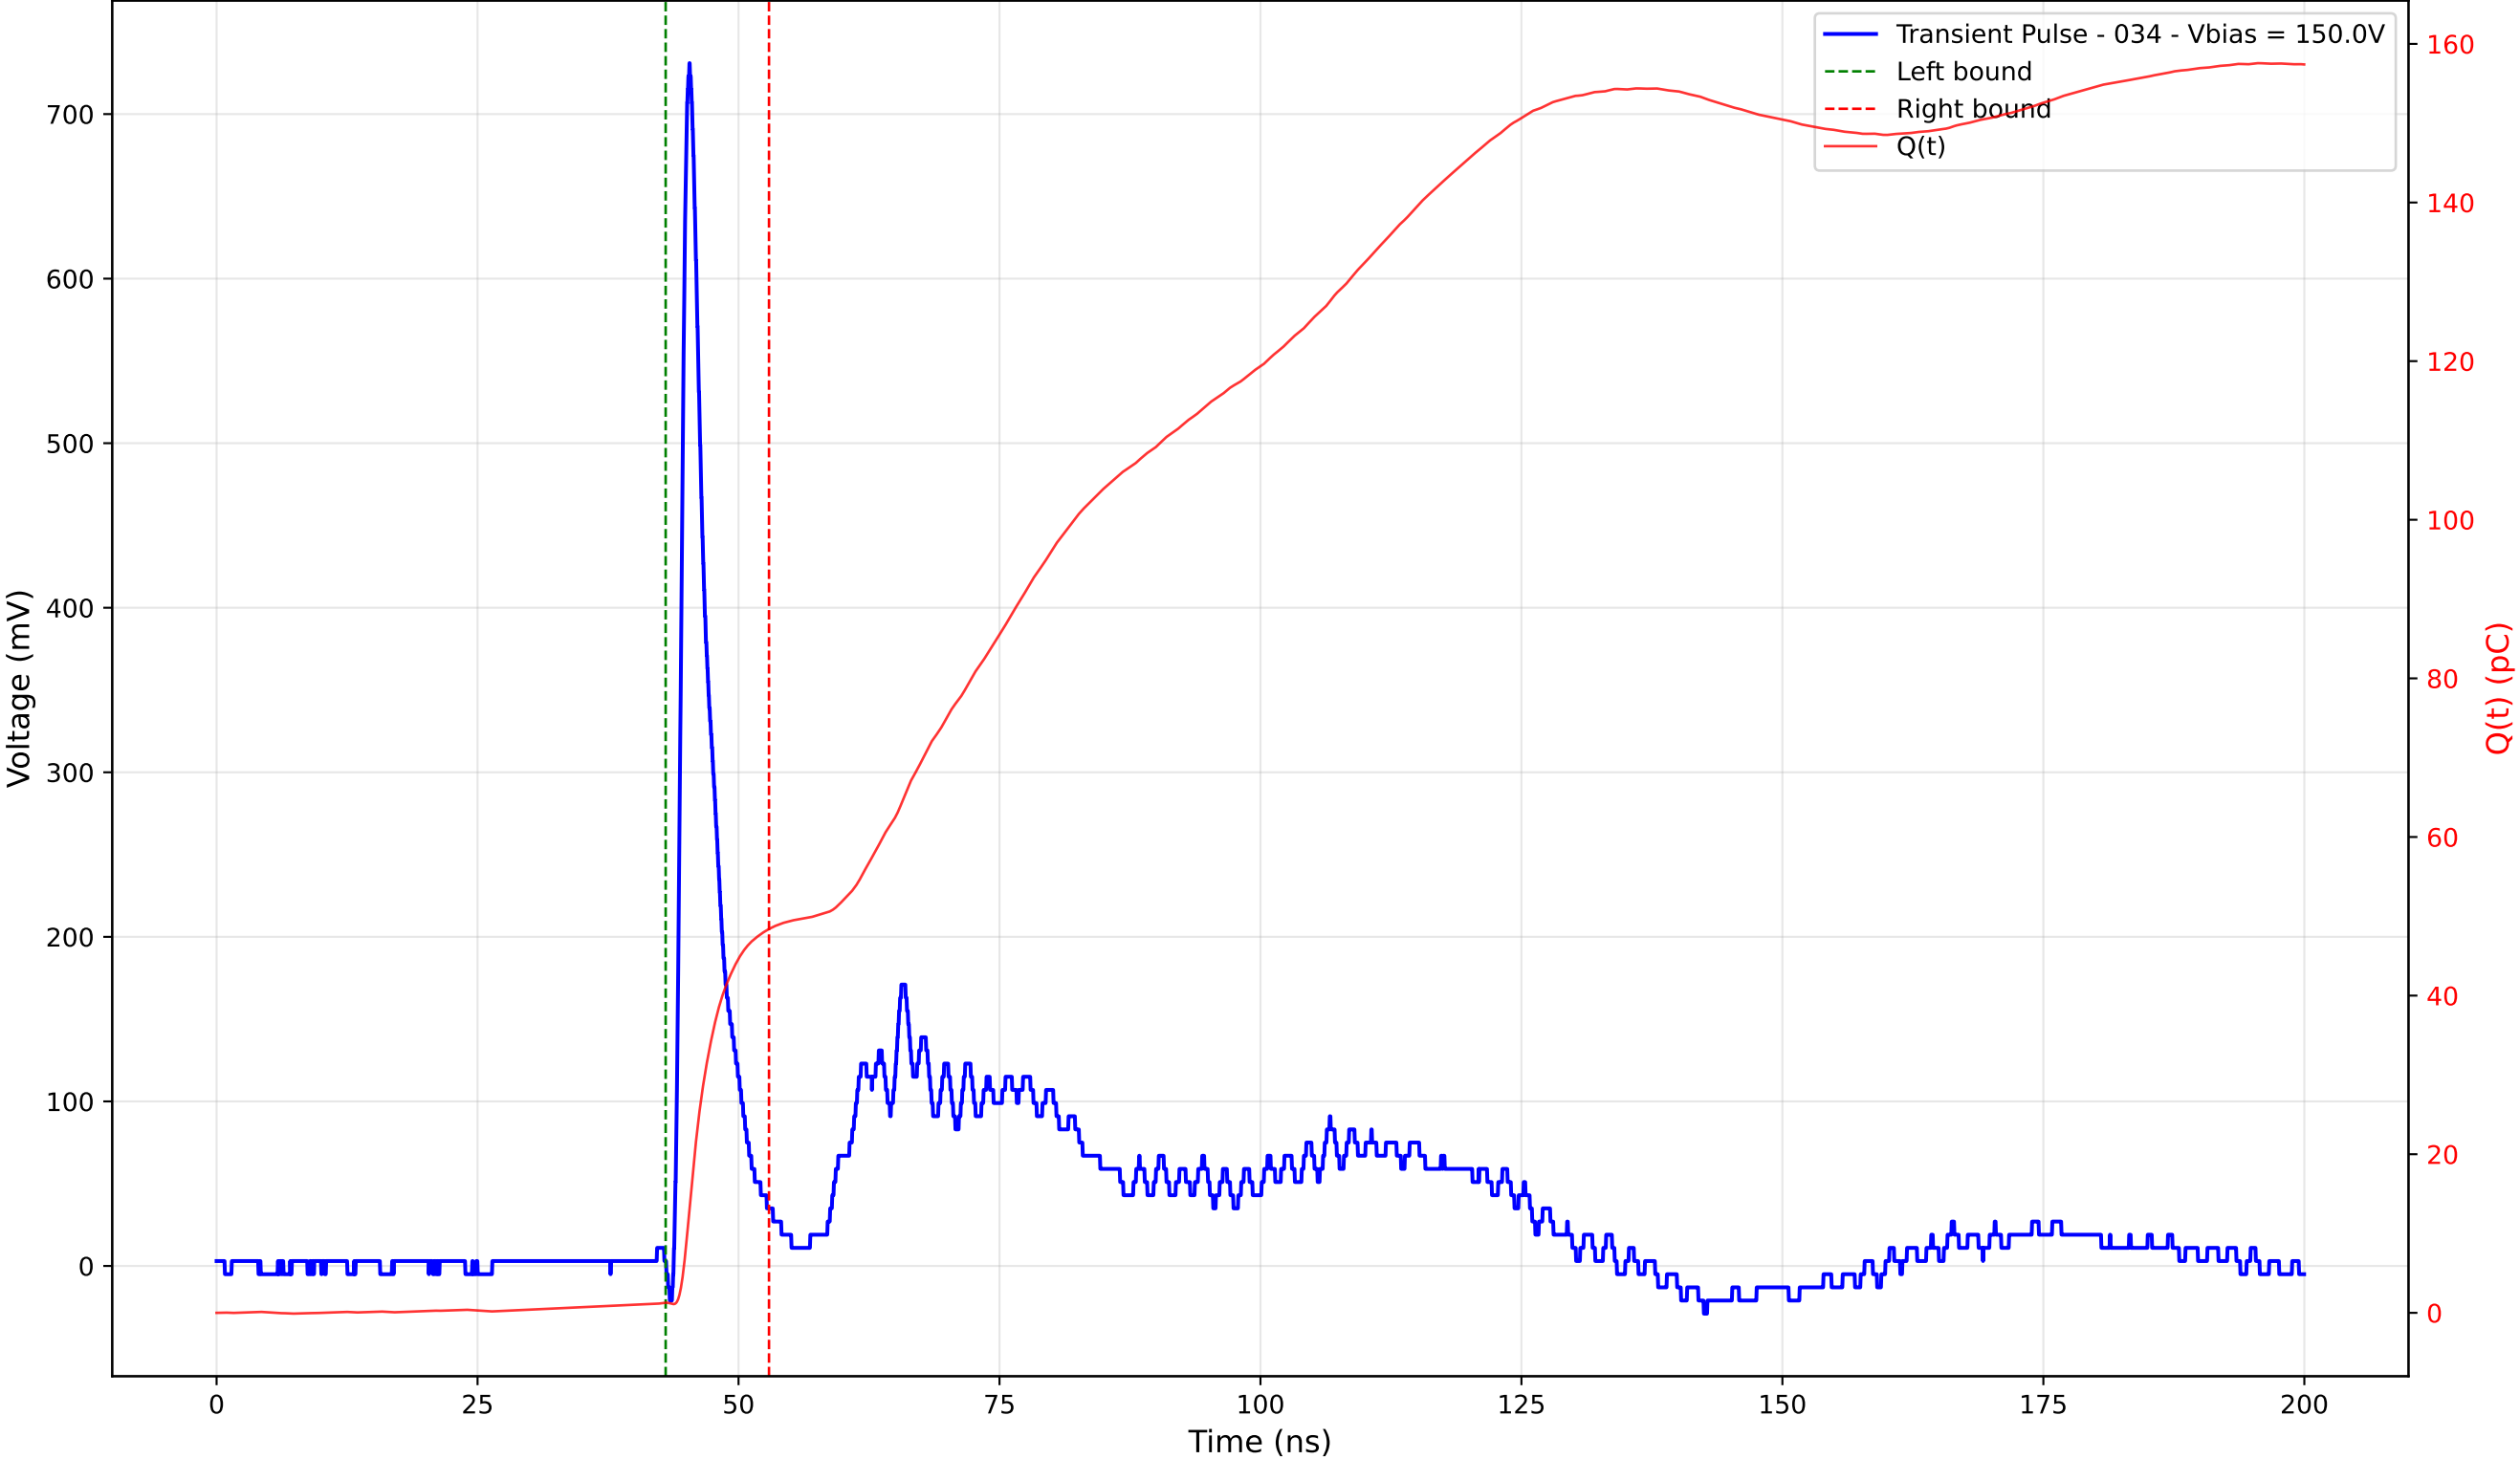


Transient Pulse - Sample: TD_4004 - Position: 100.0 μm - Charge: 50.29 pC - Rise Time: 0.90 ns

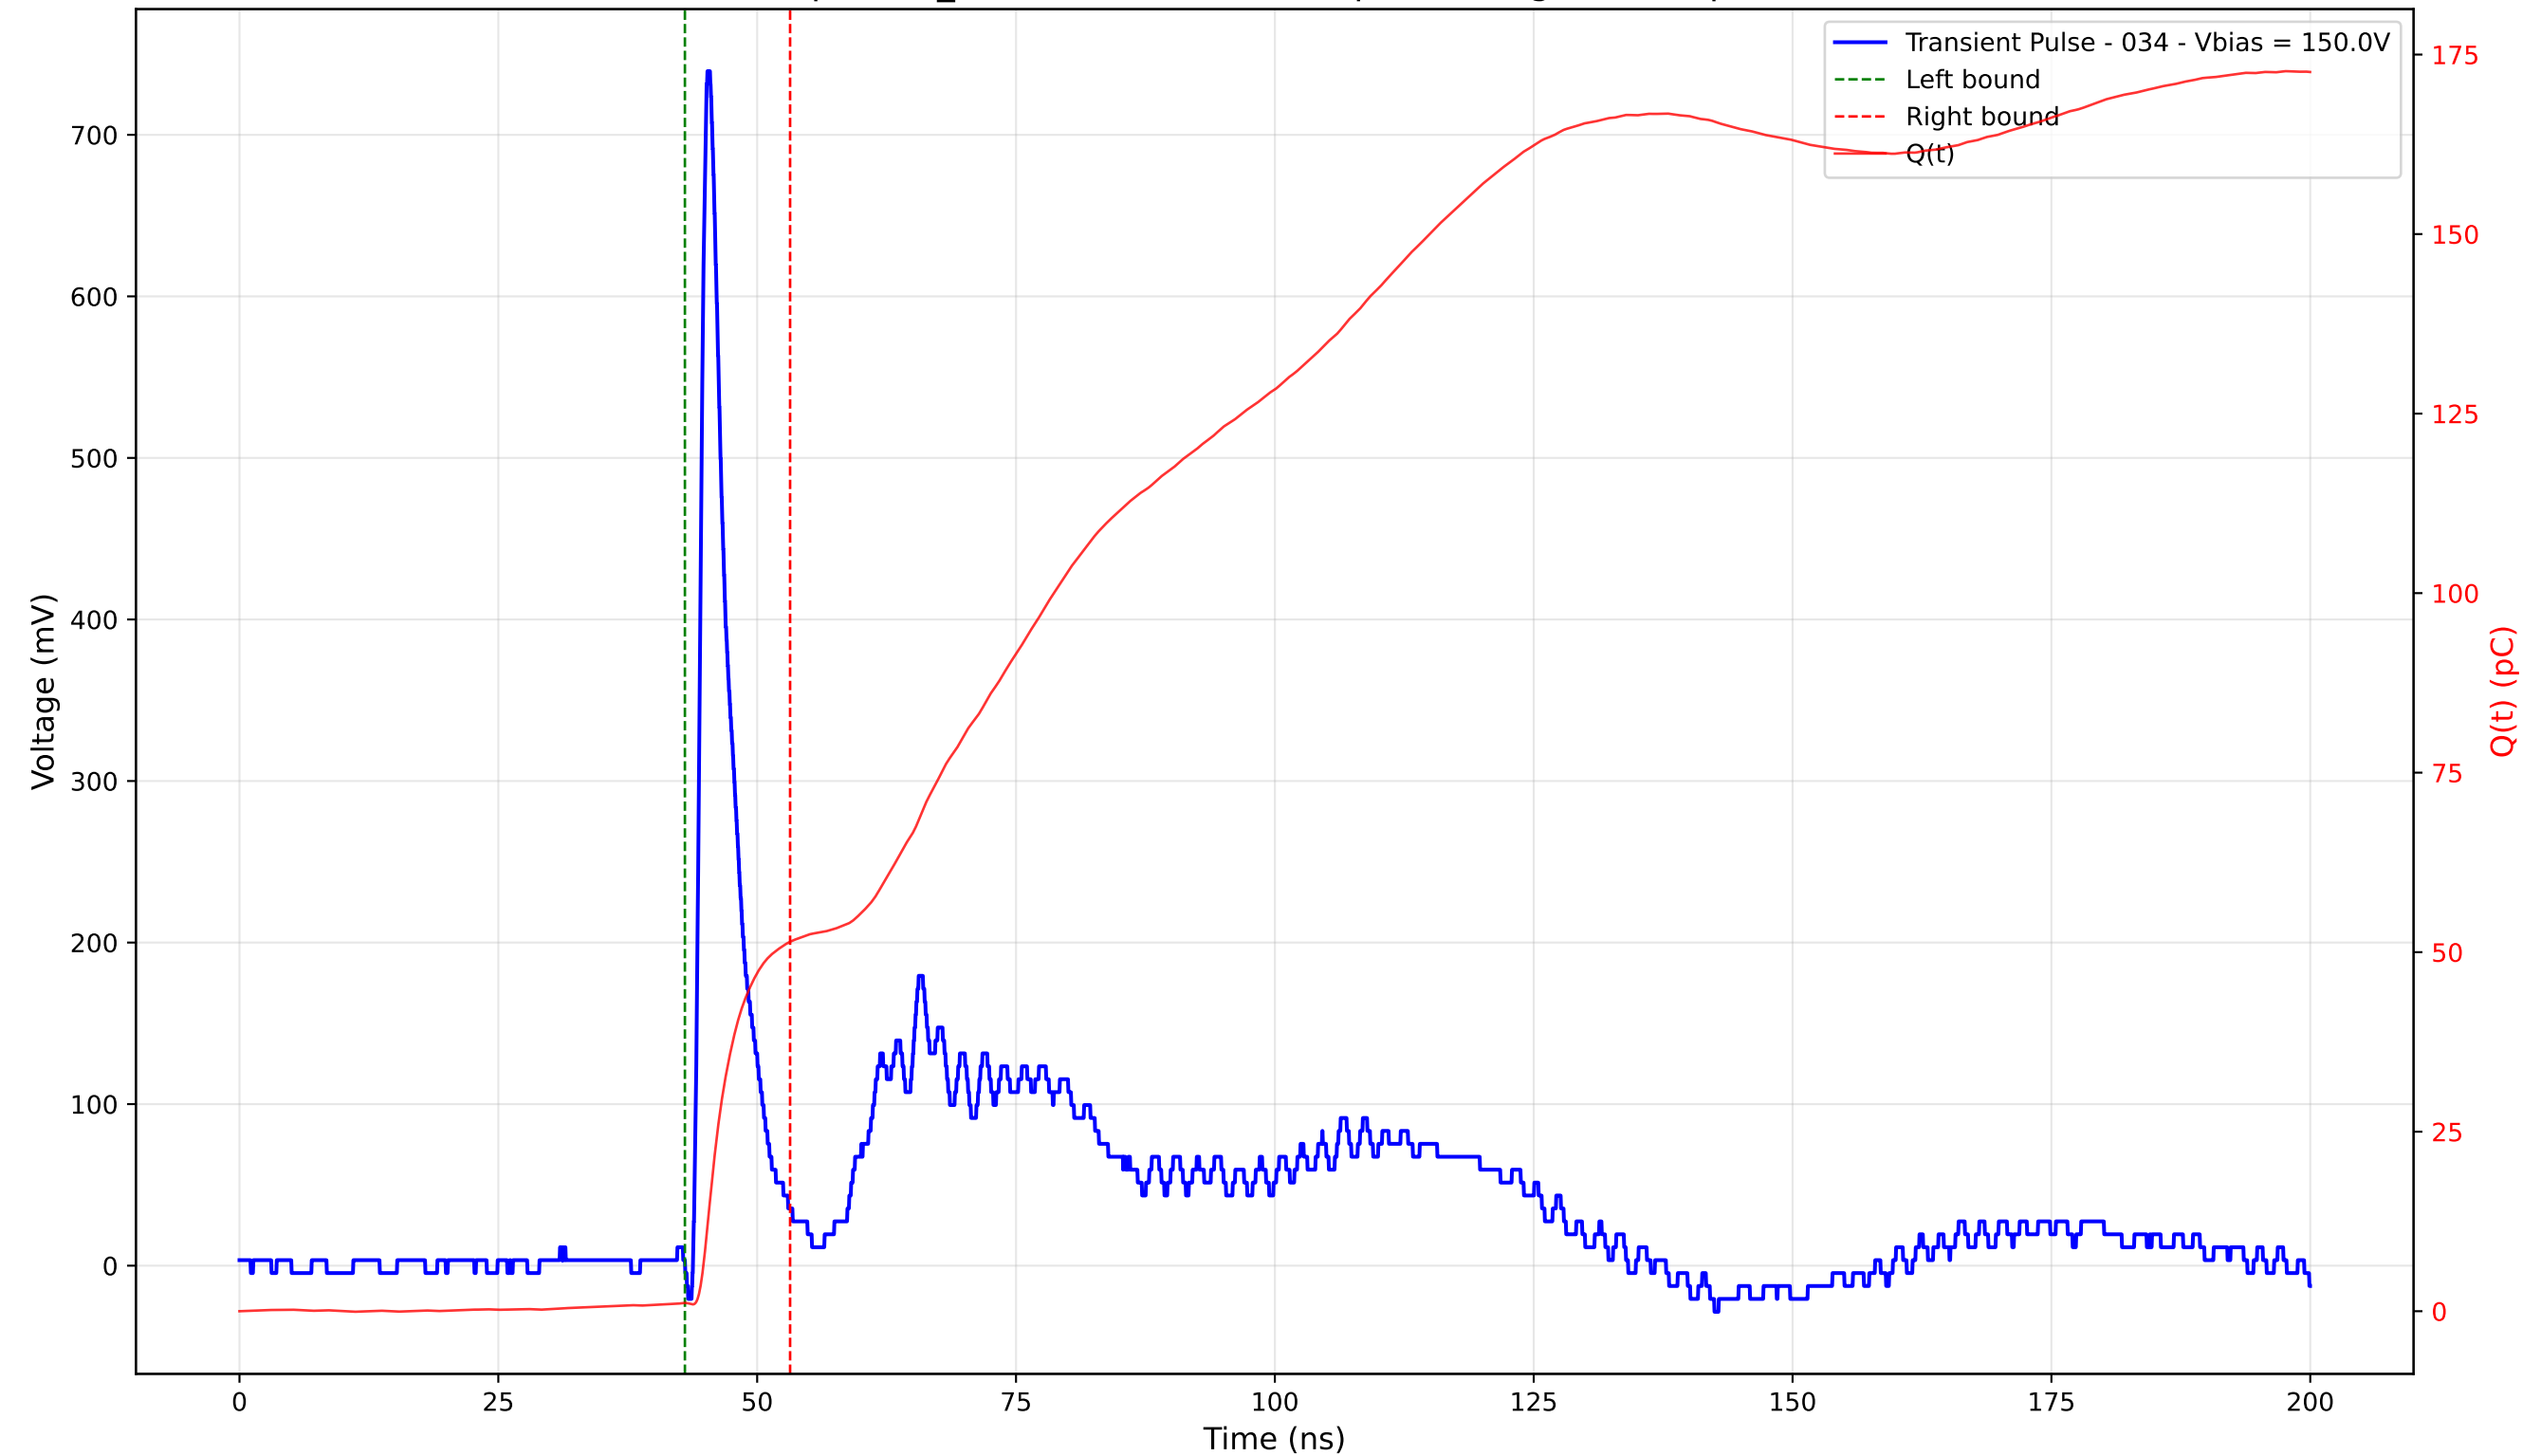


Transient Pulse - Sample: TD_4004 - Position: 105.0 μm - Charge: 52.41 pC - Rise Time: 0.93 ns

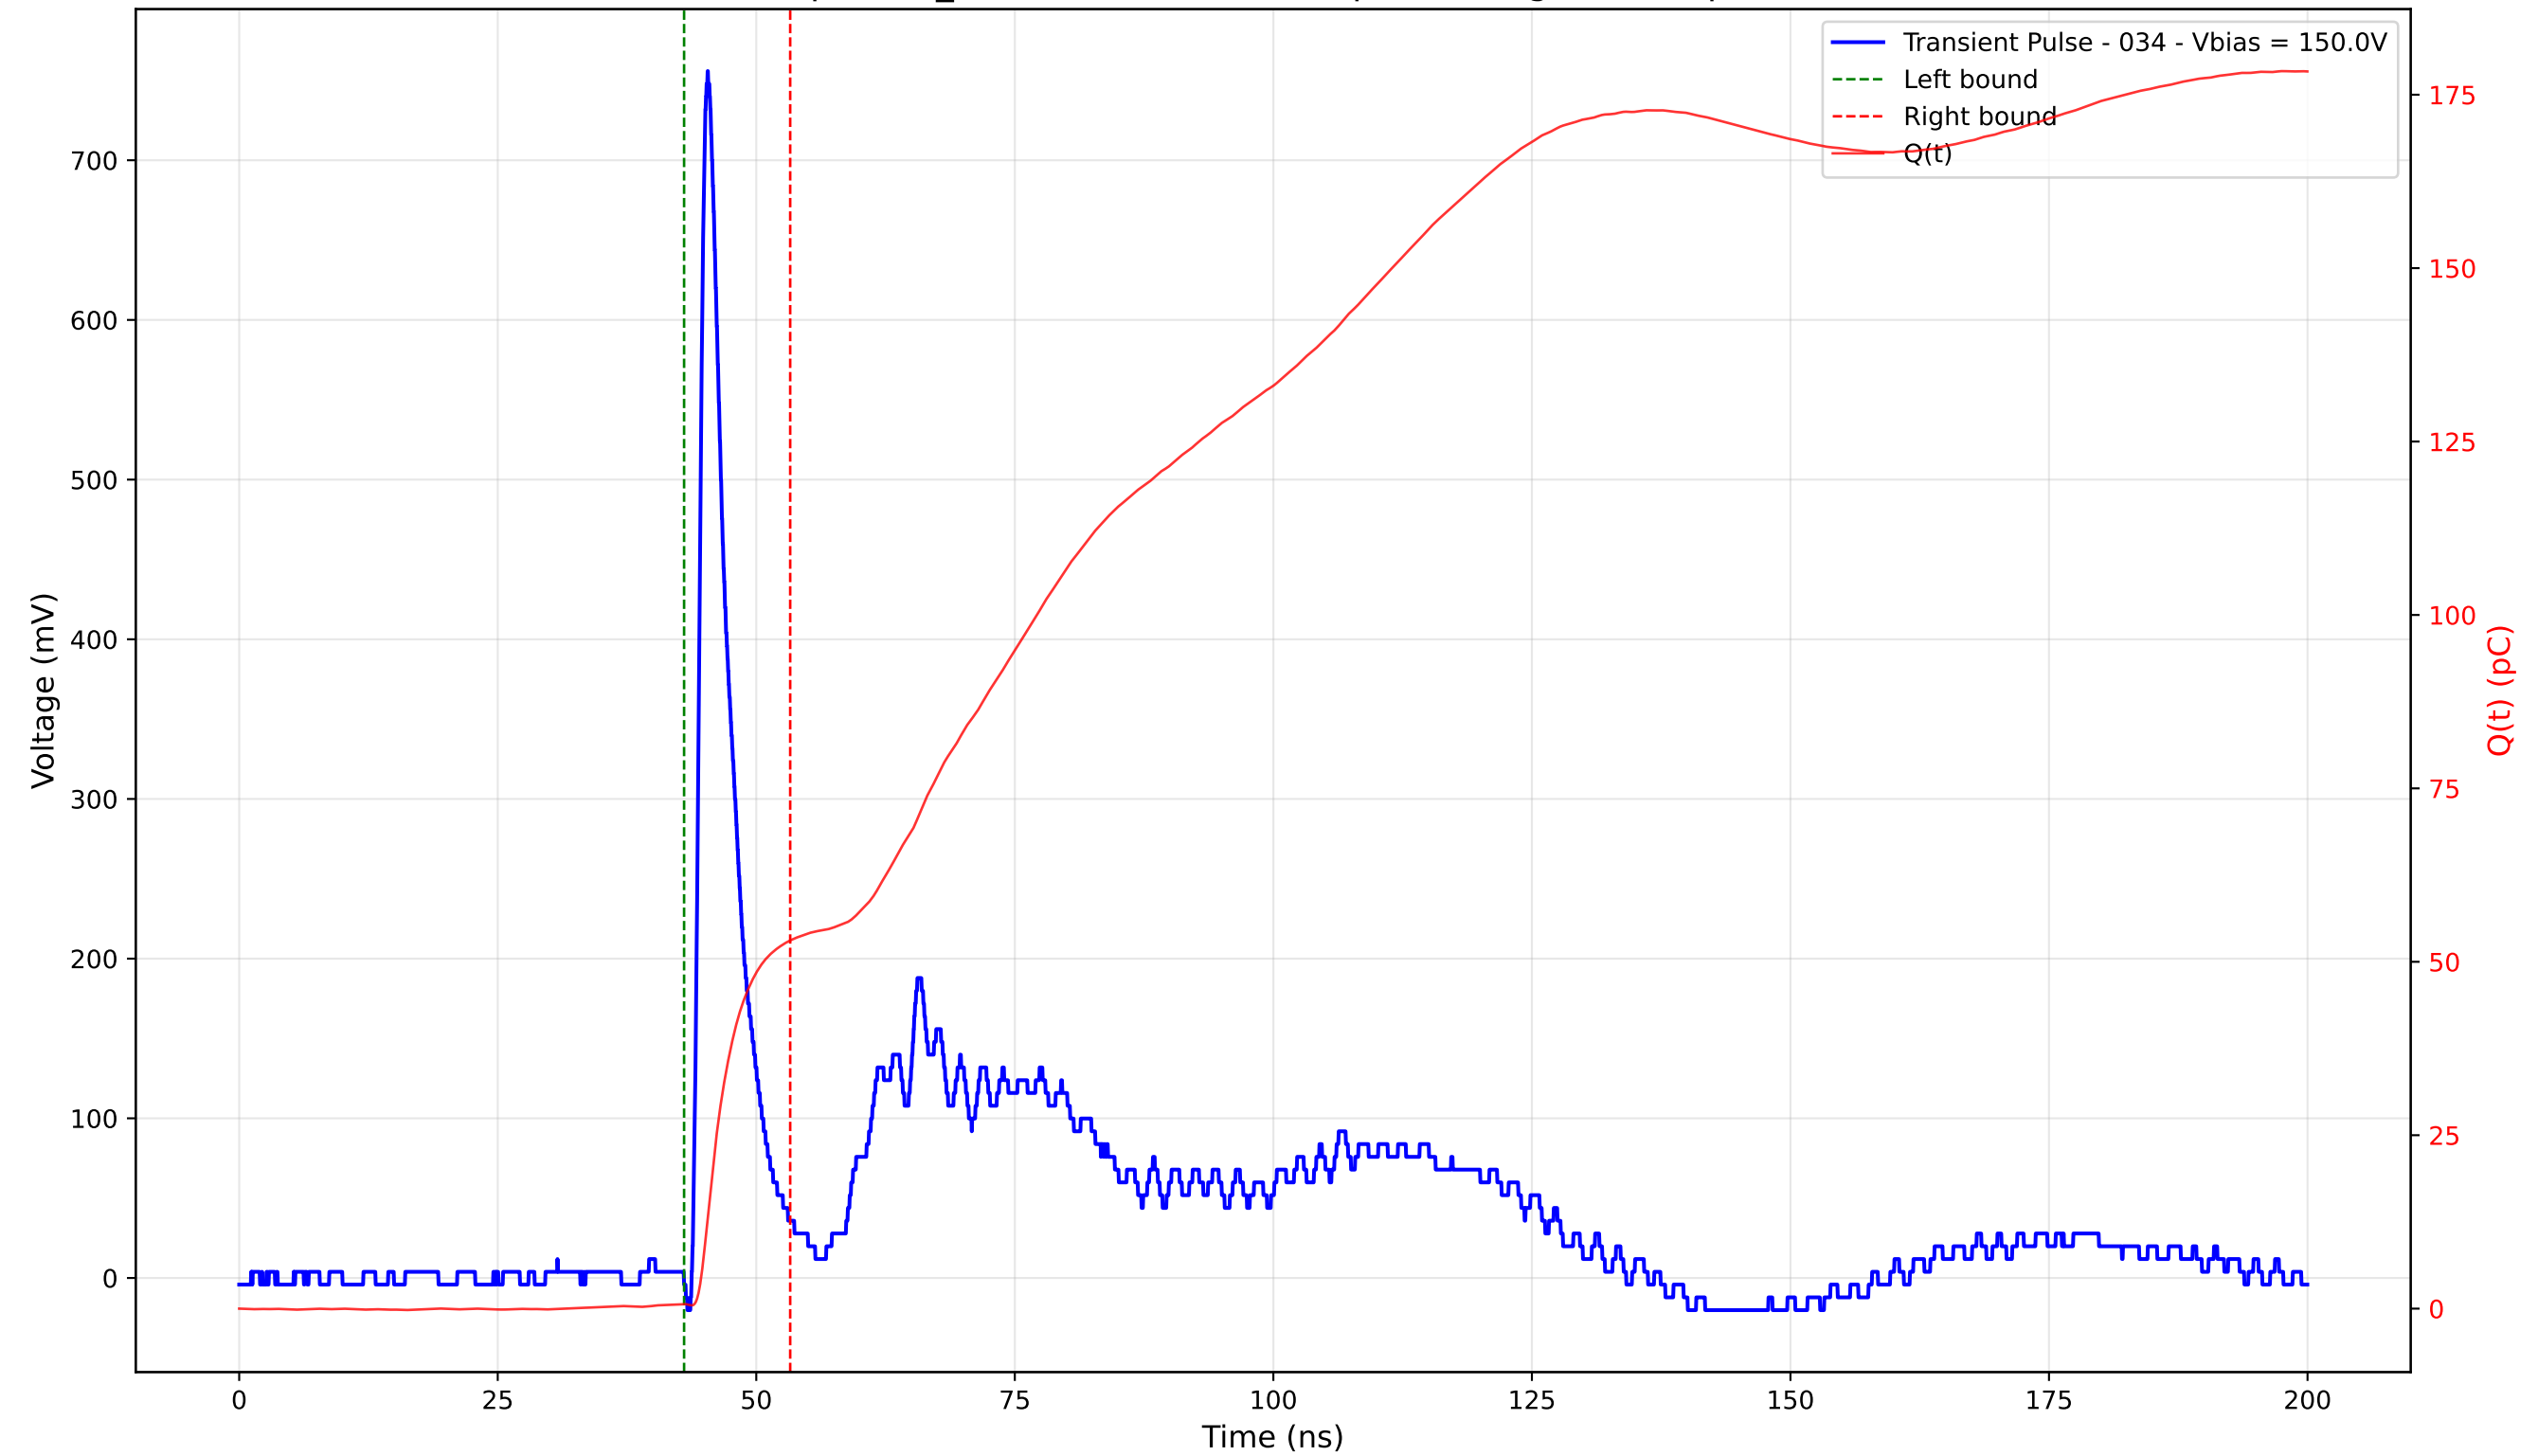


Transient Pulse - Sample: TD_4004 - Position: 110.0 μm - Charge: 53.13 pC - Rise Time: 0.90 ns

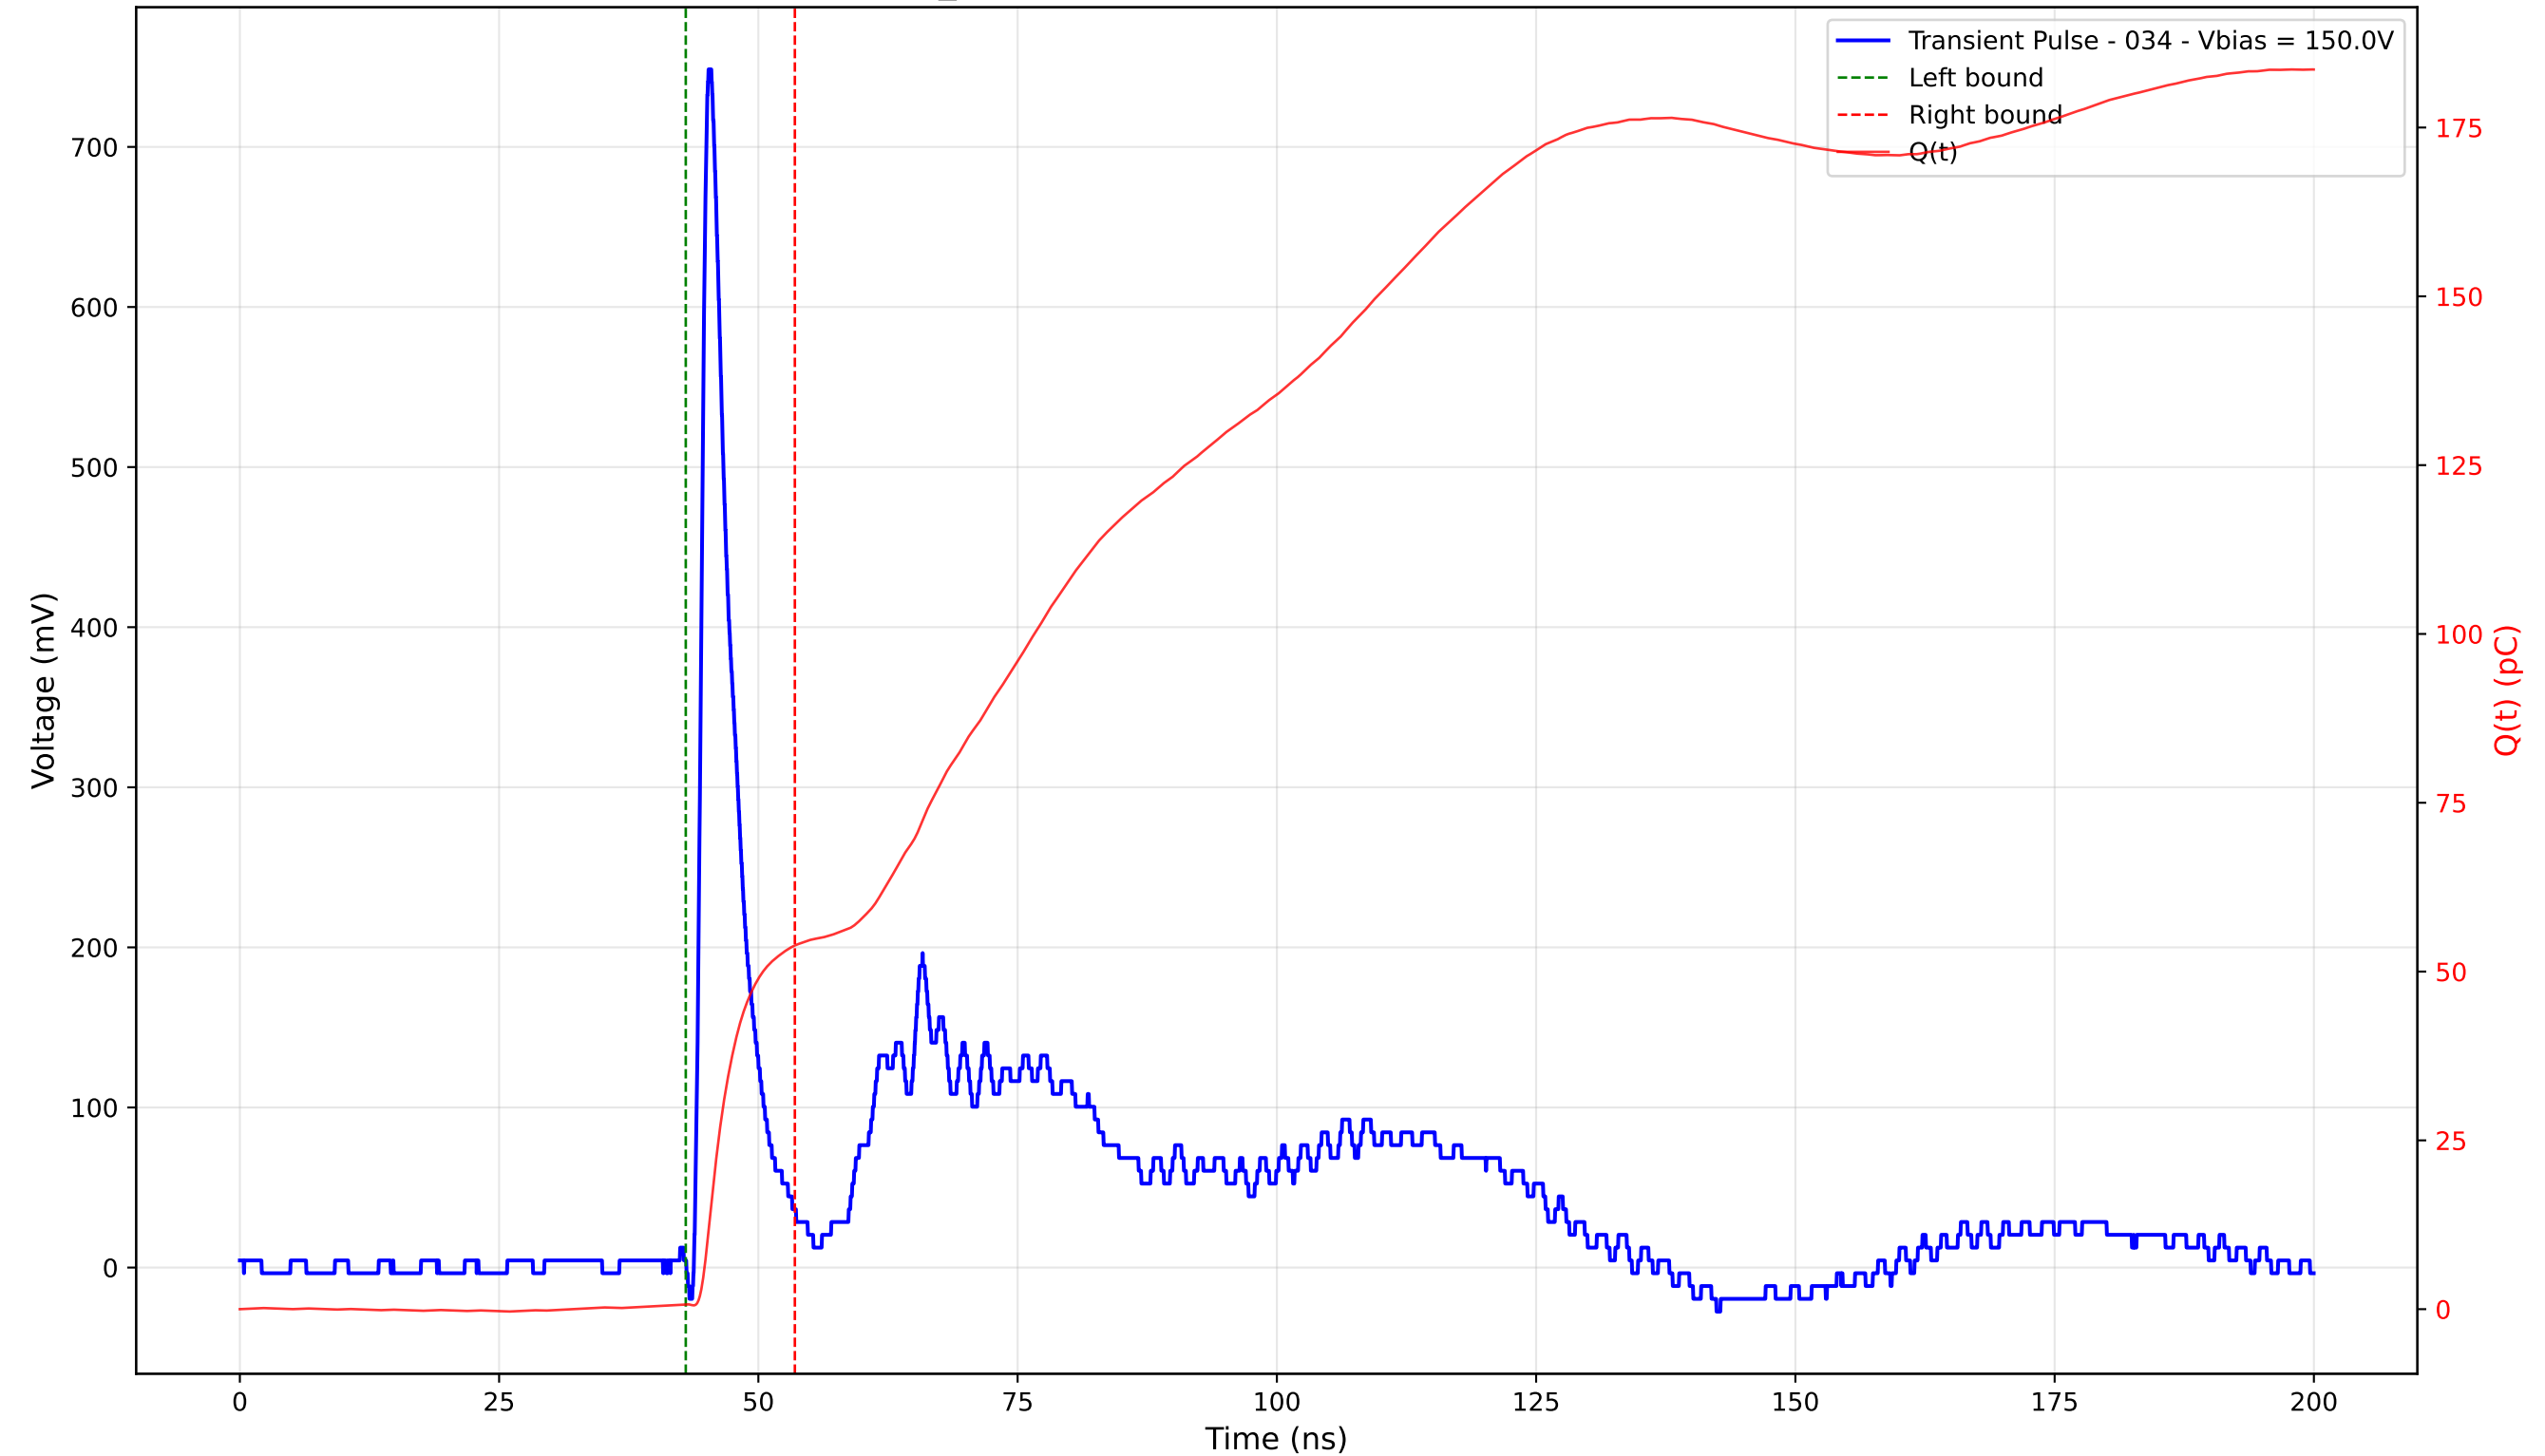


Transient Pulse - Sample: TD_4004 - Position: 115.0 μm - Charge: 52.11 pC - Rise Time: 0.91 ns

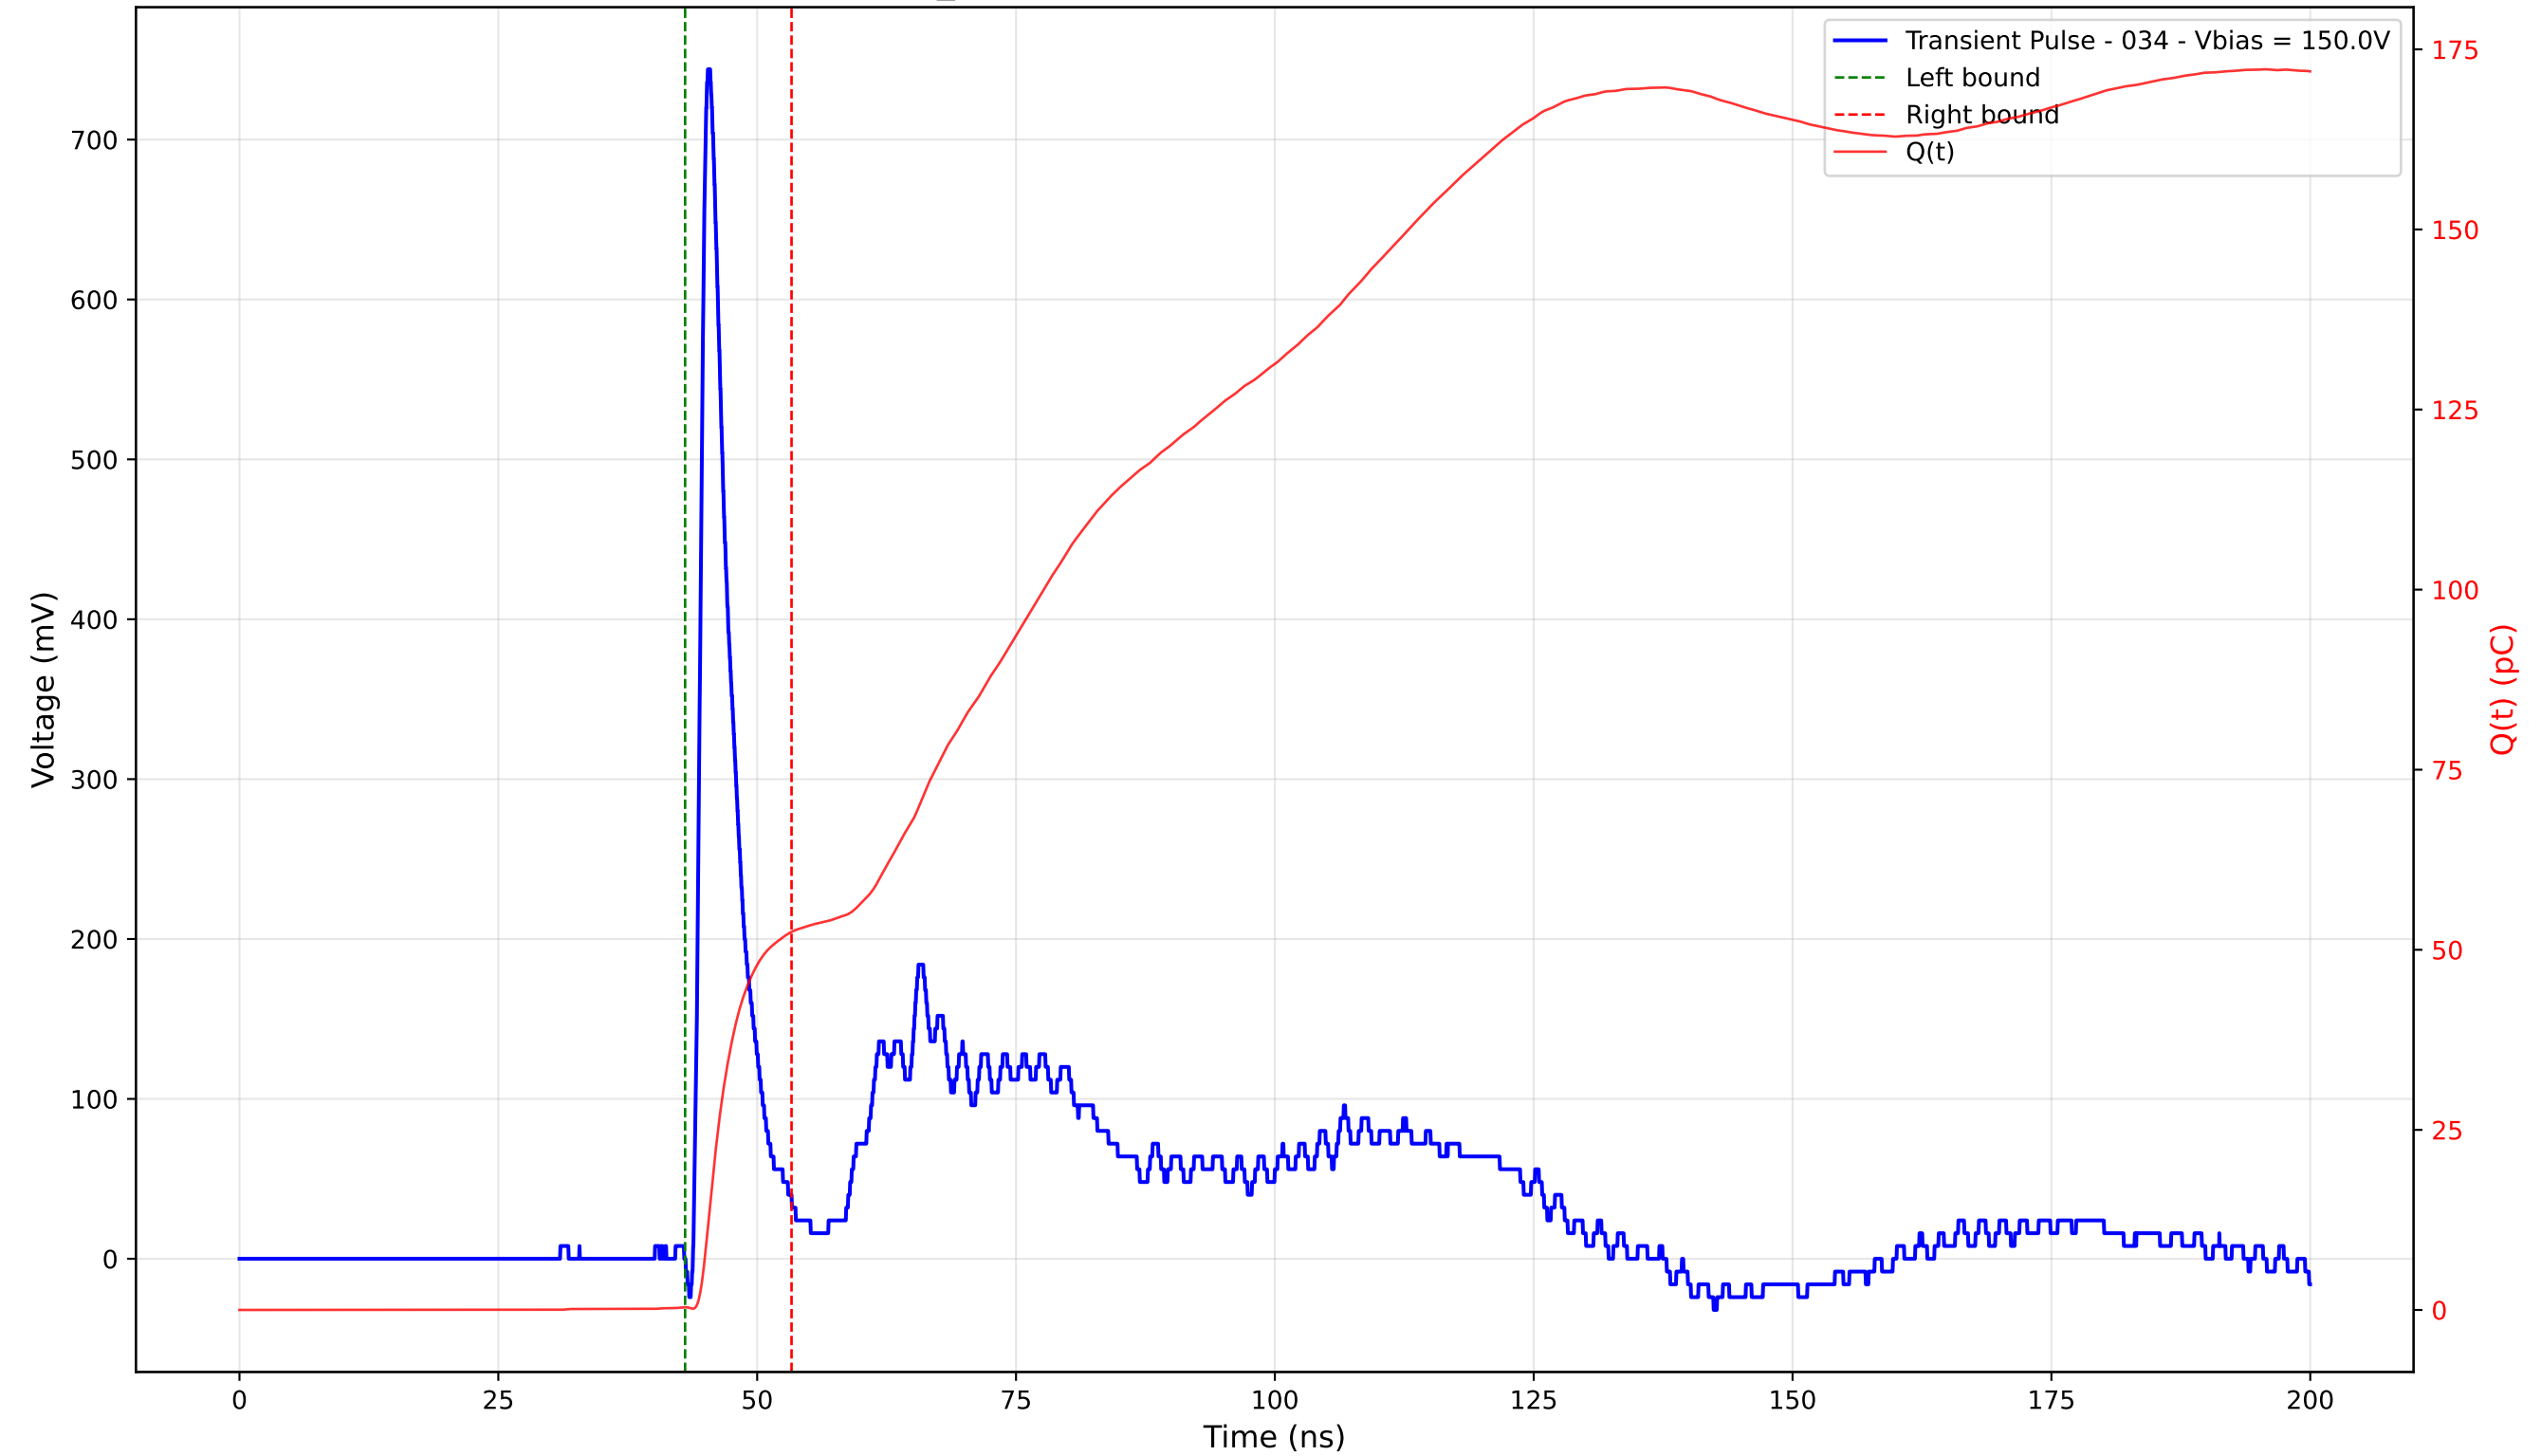


Transient Pulse - Sample: TD_4004 - Position: 120.0 μm - Charge: 51.40 pC - Rise Time: 0.94 ns

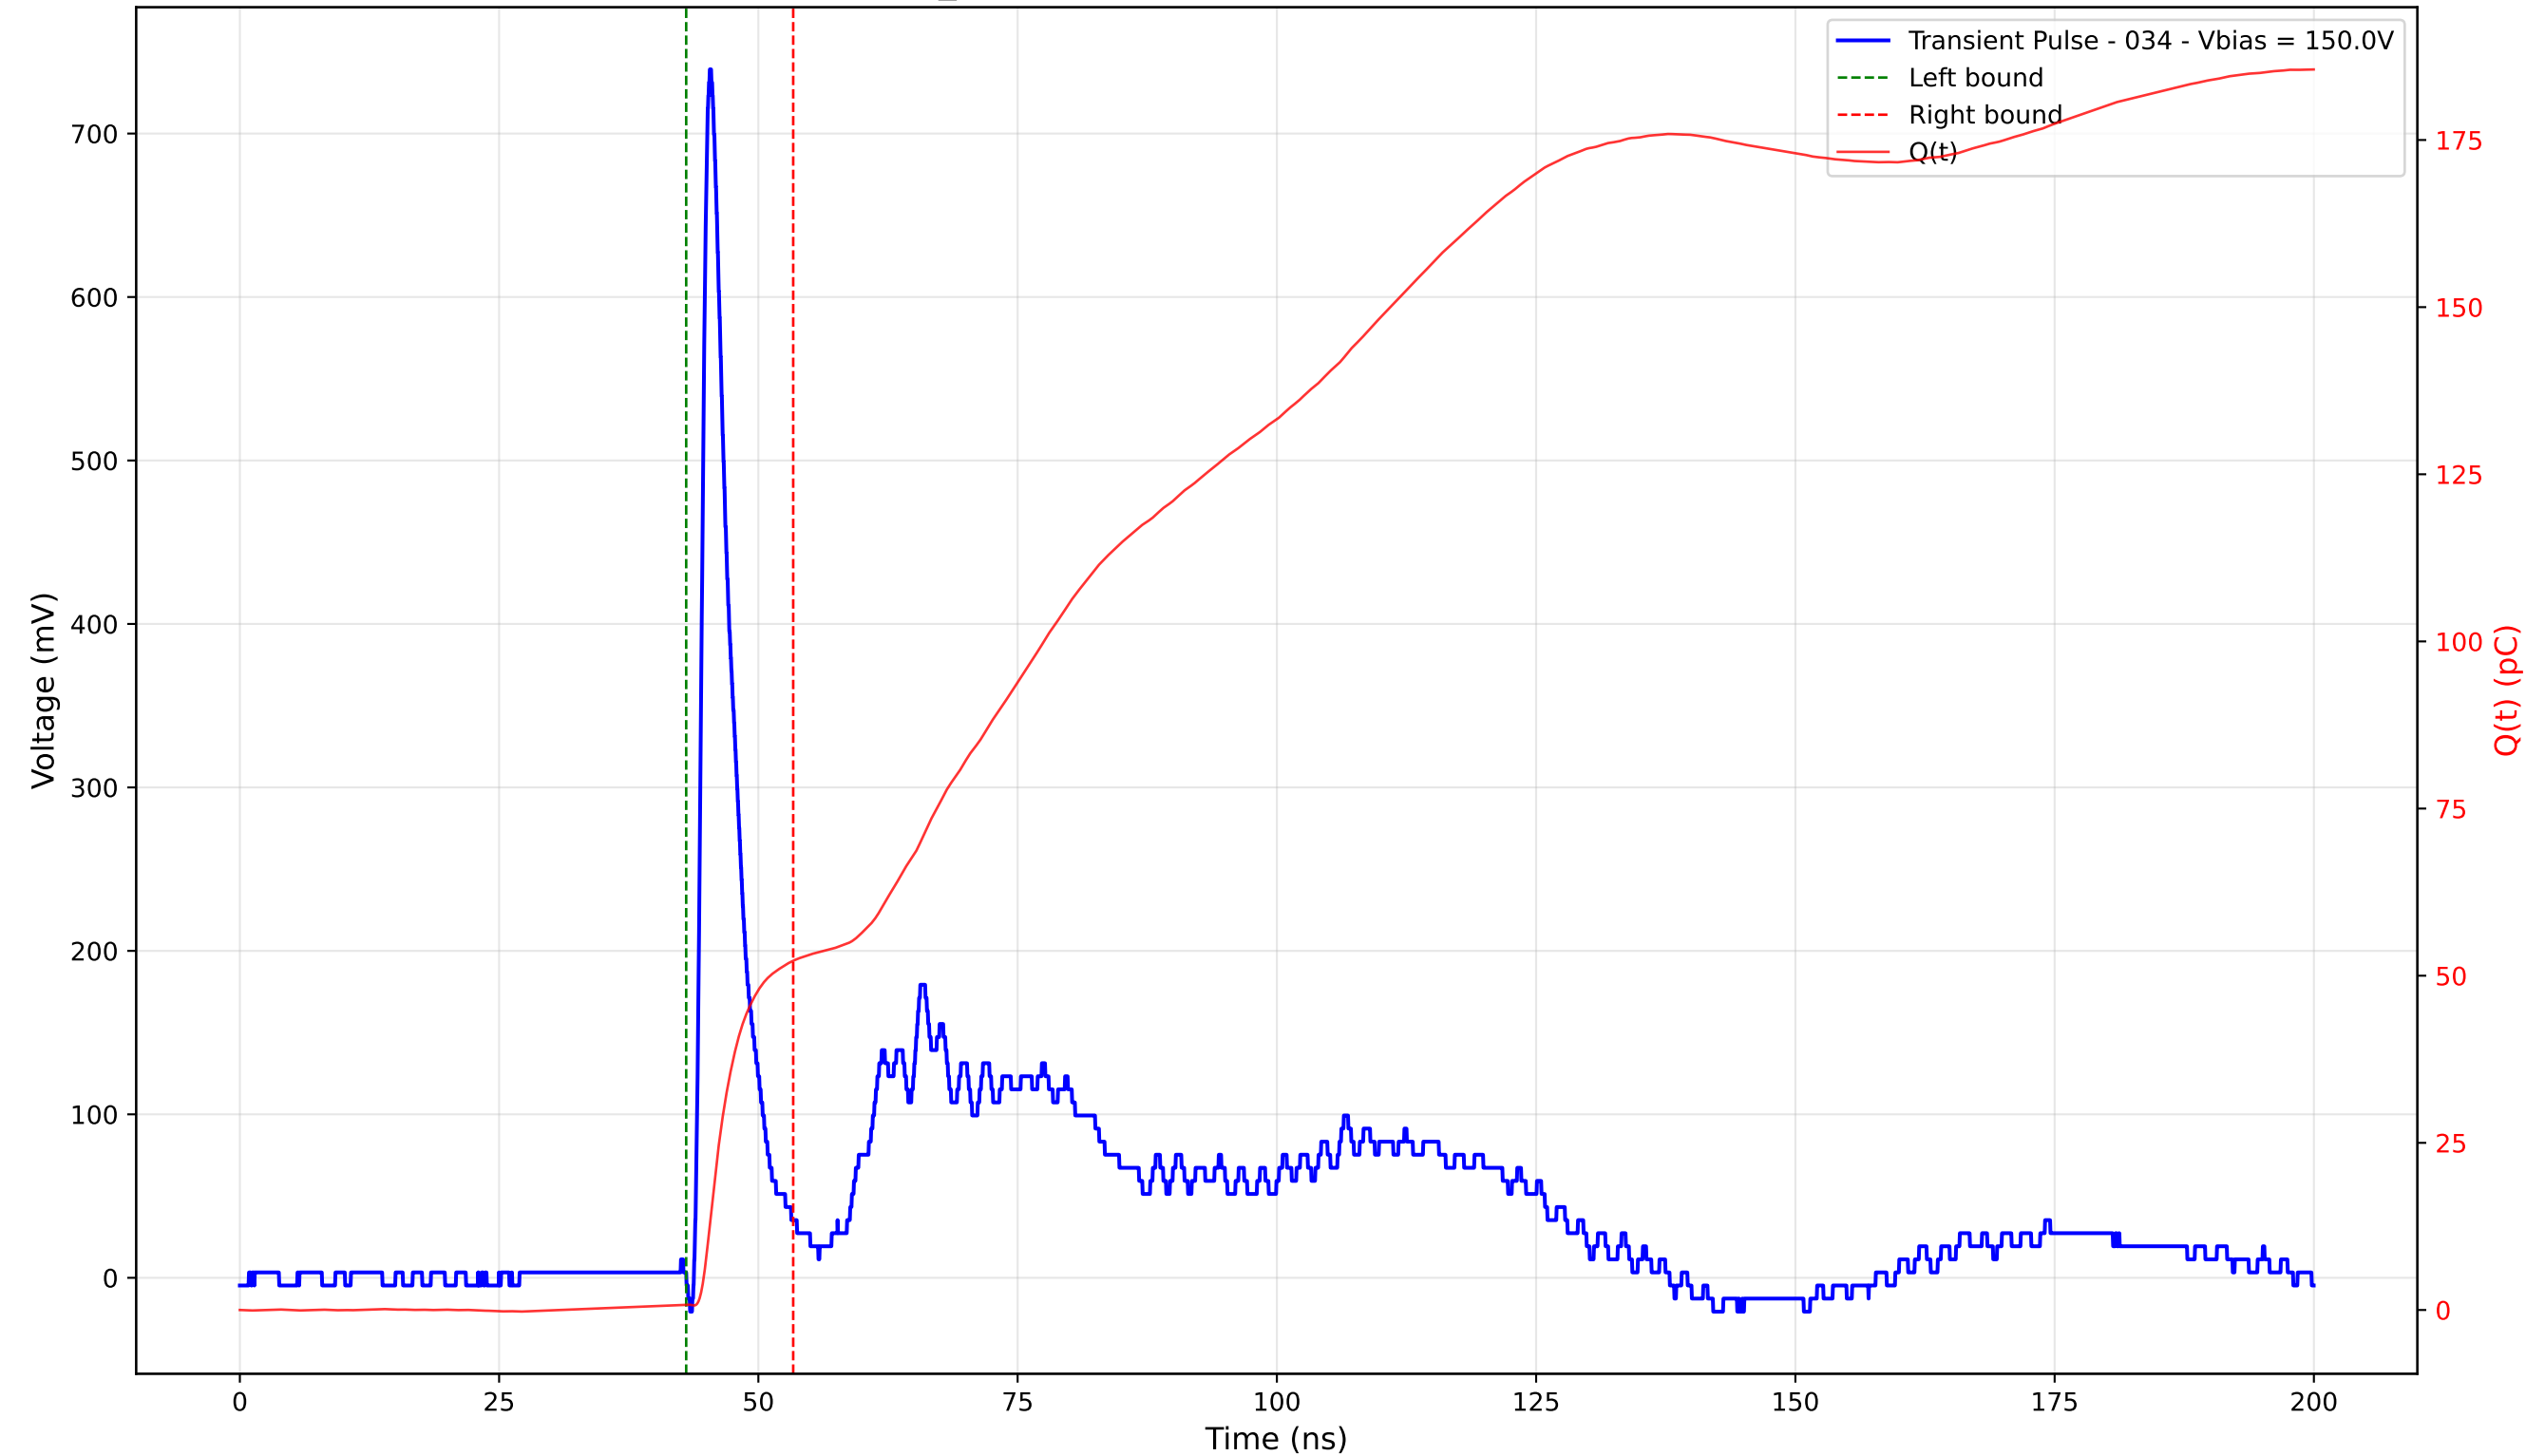


Transient Pulse - Sample: TD_4004 - Position: 125.0 μm - Charge: 49.92 pC - Rise Time: 0.95 ns

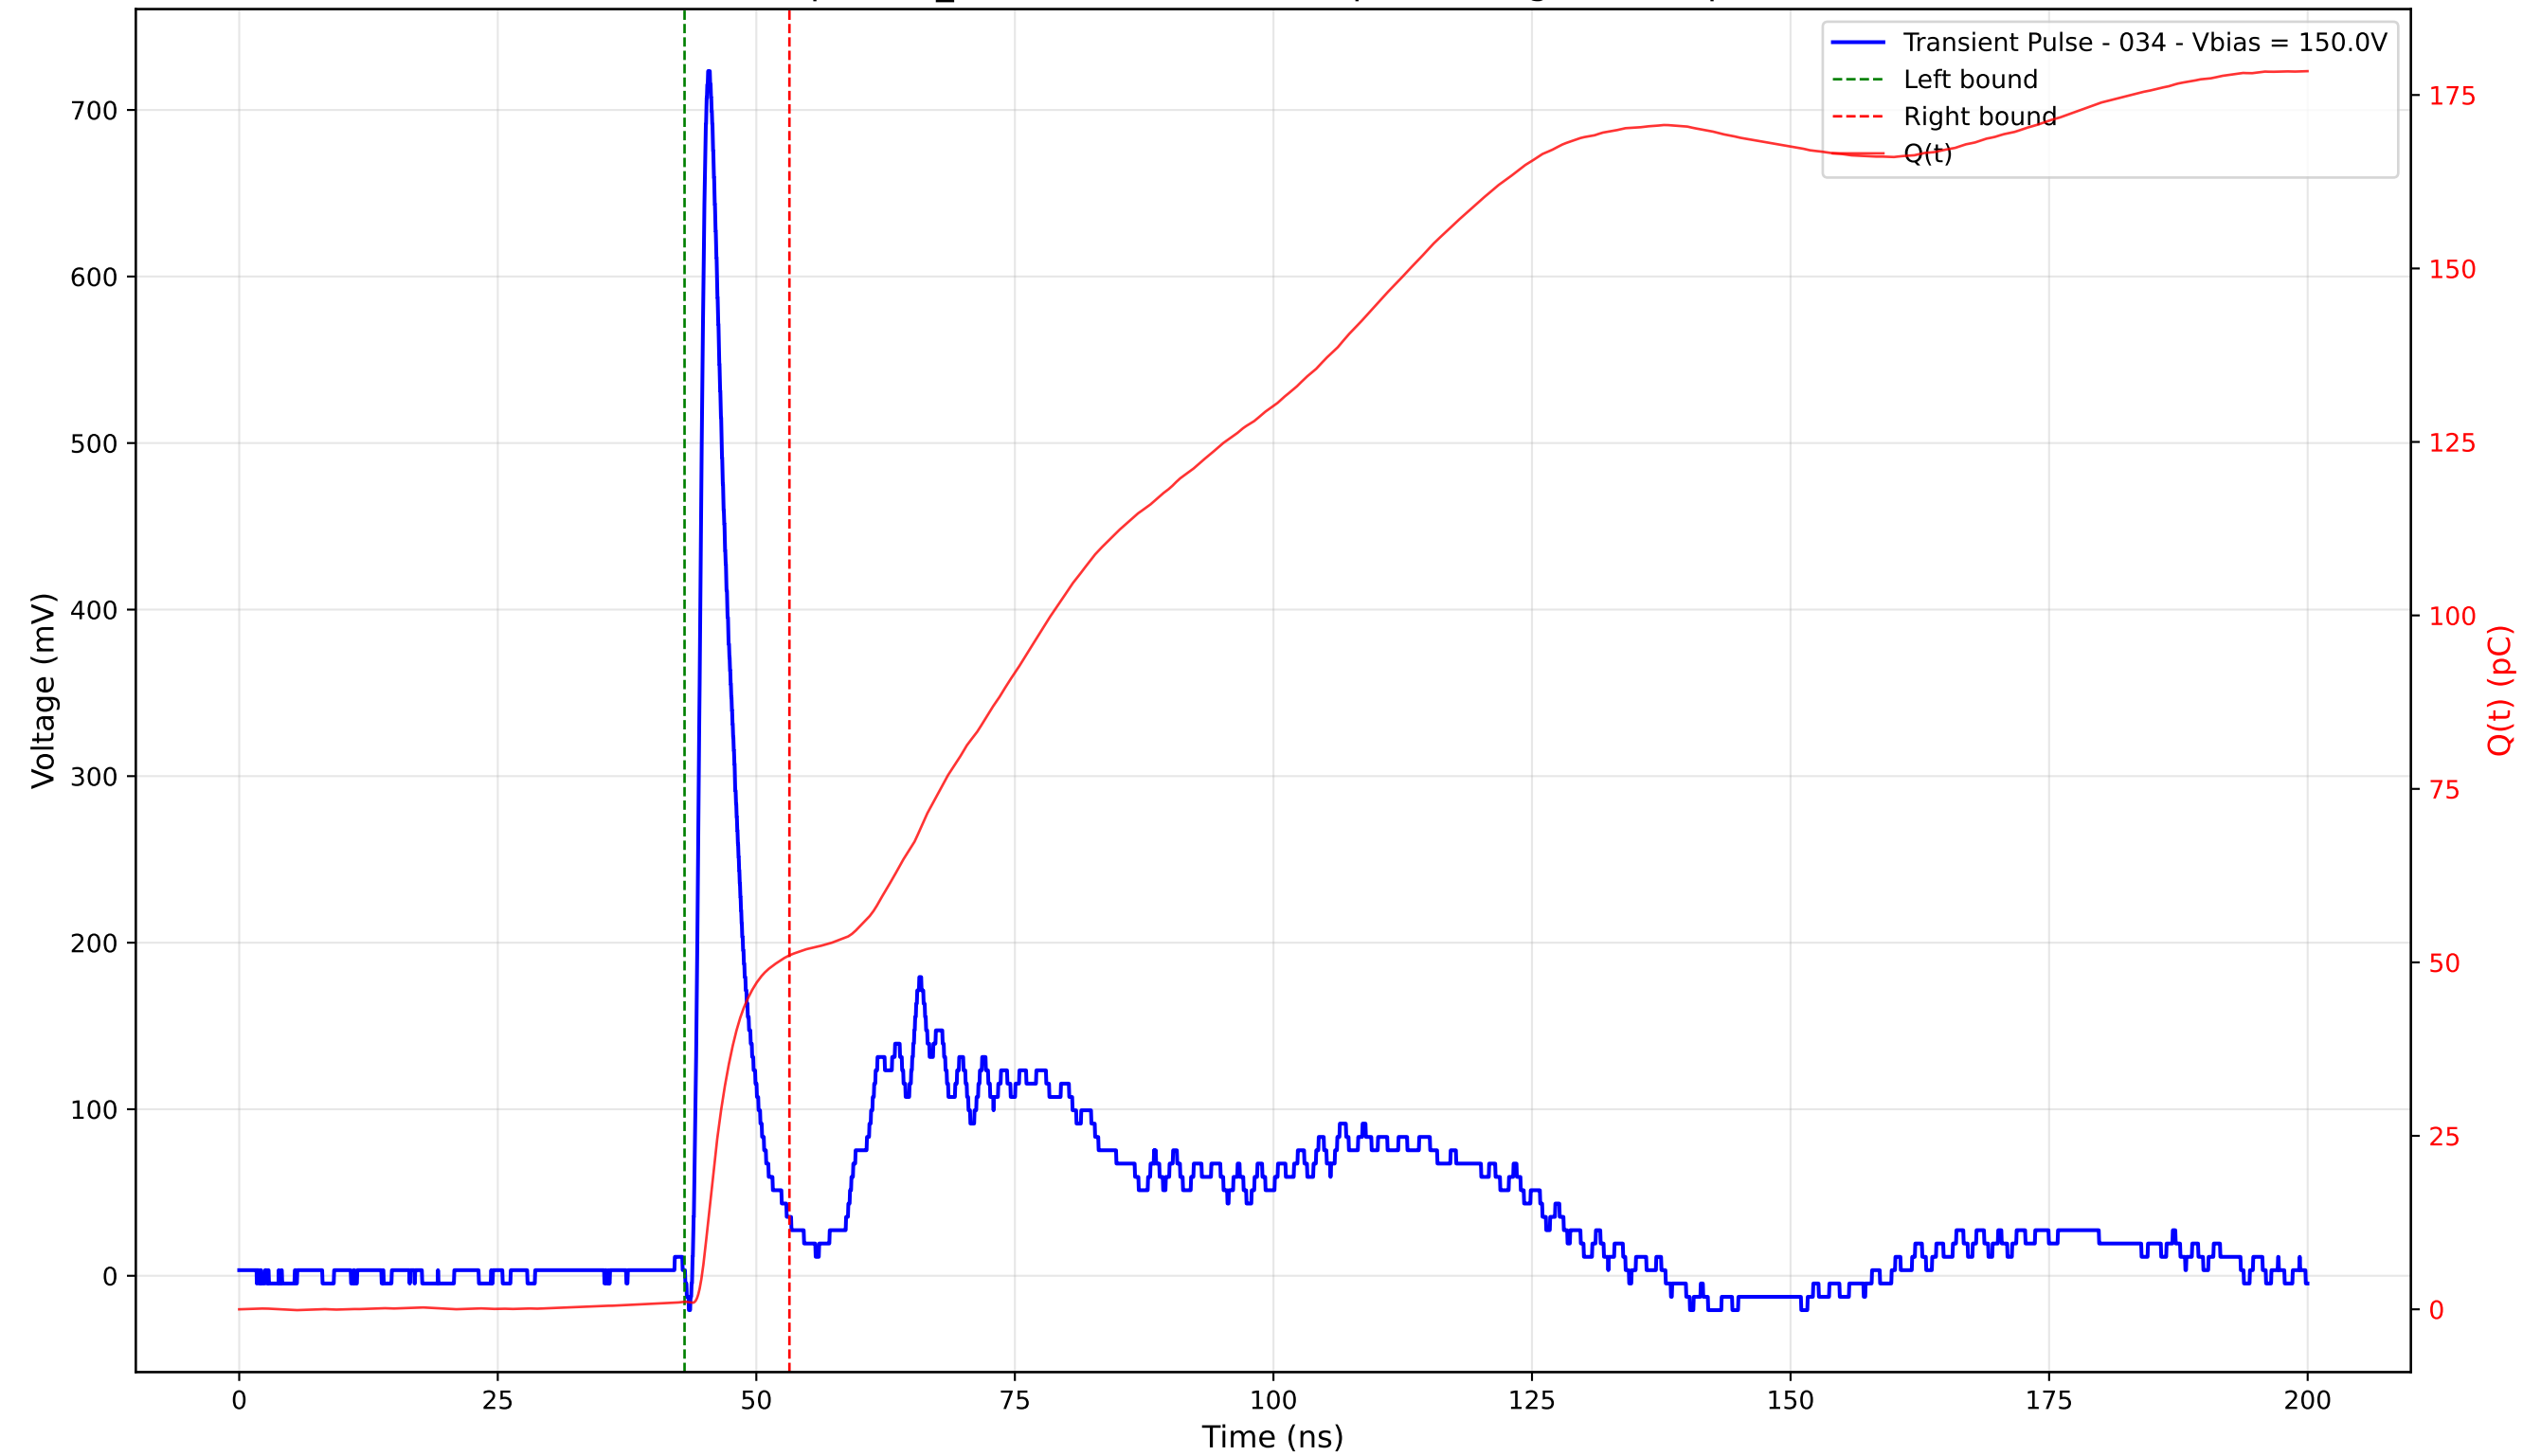


Transient Pulse - Sample: TD_4004 - Position: 130.0 μm - Charge: 47.52 pC - Rise Time: 0.99 ns

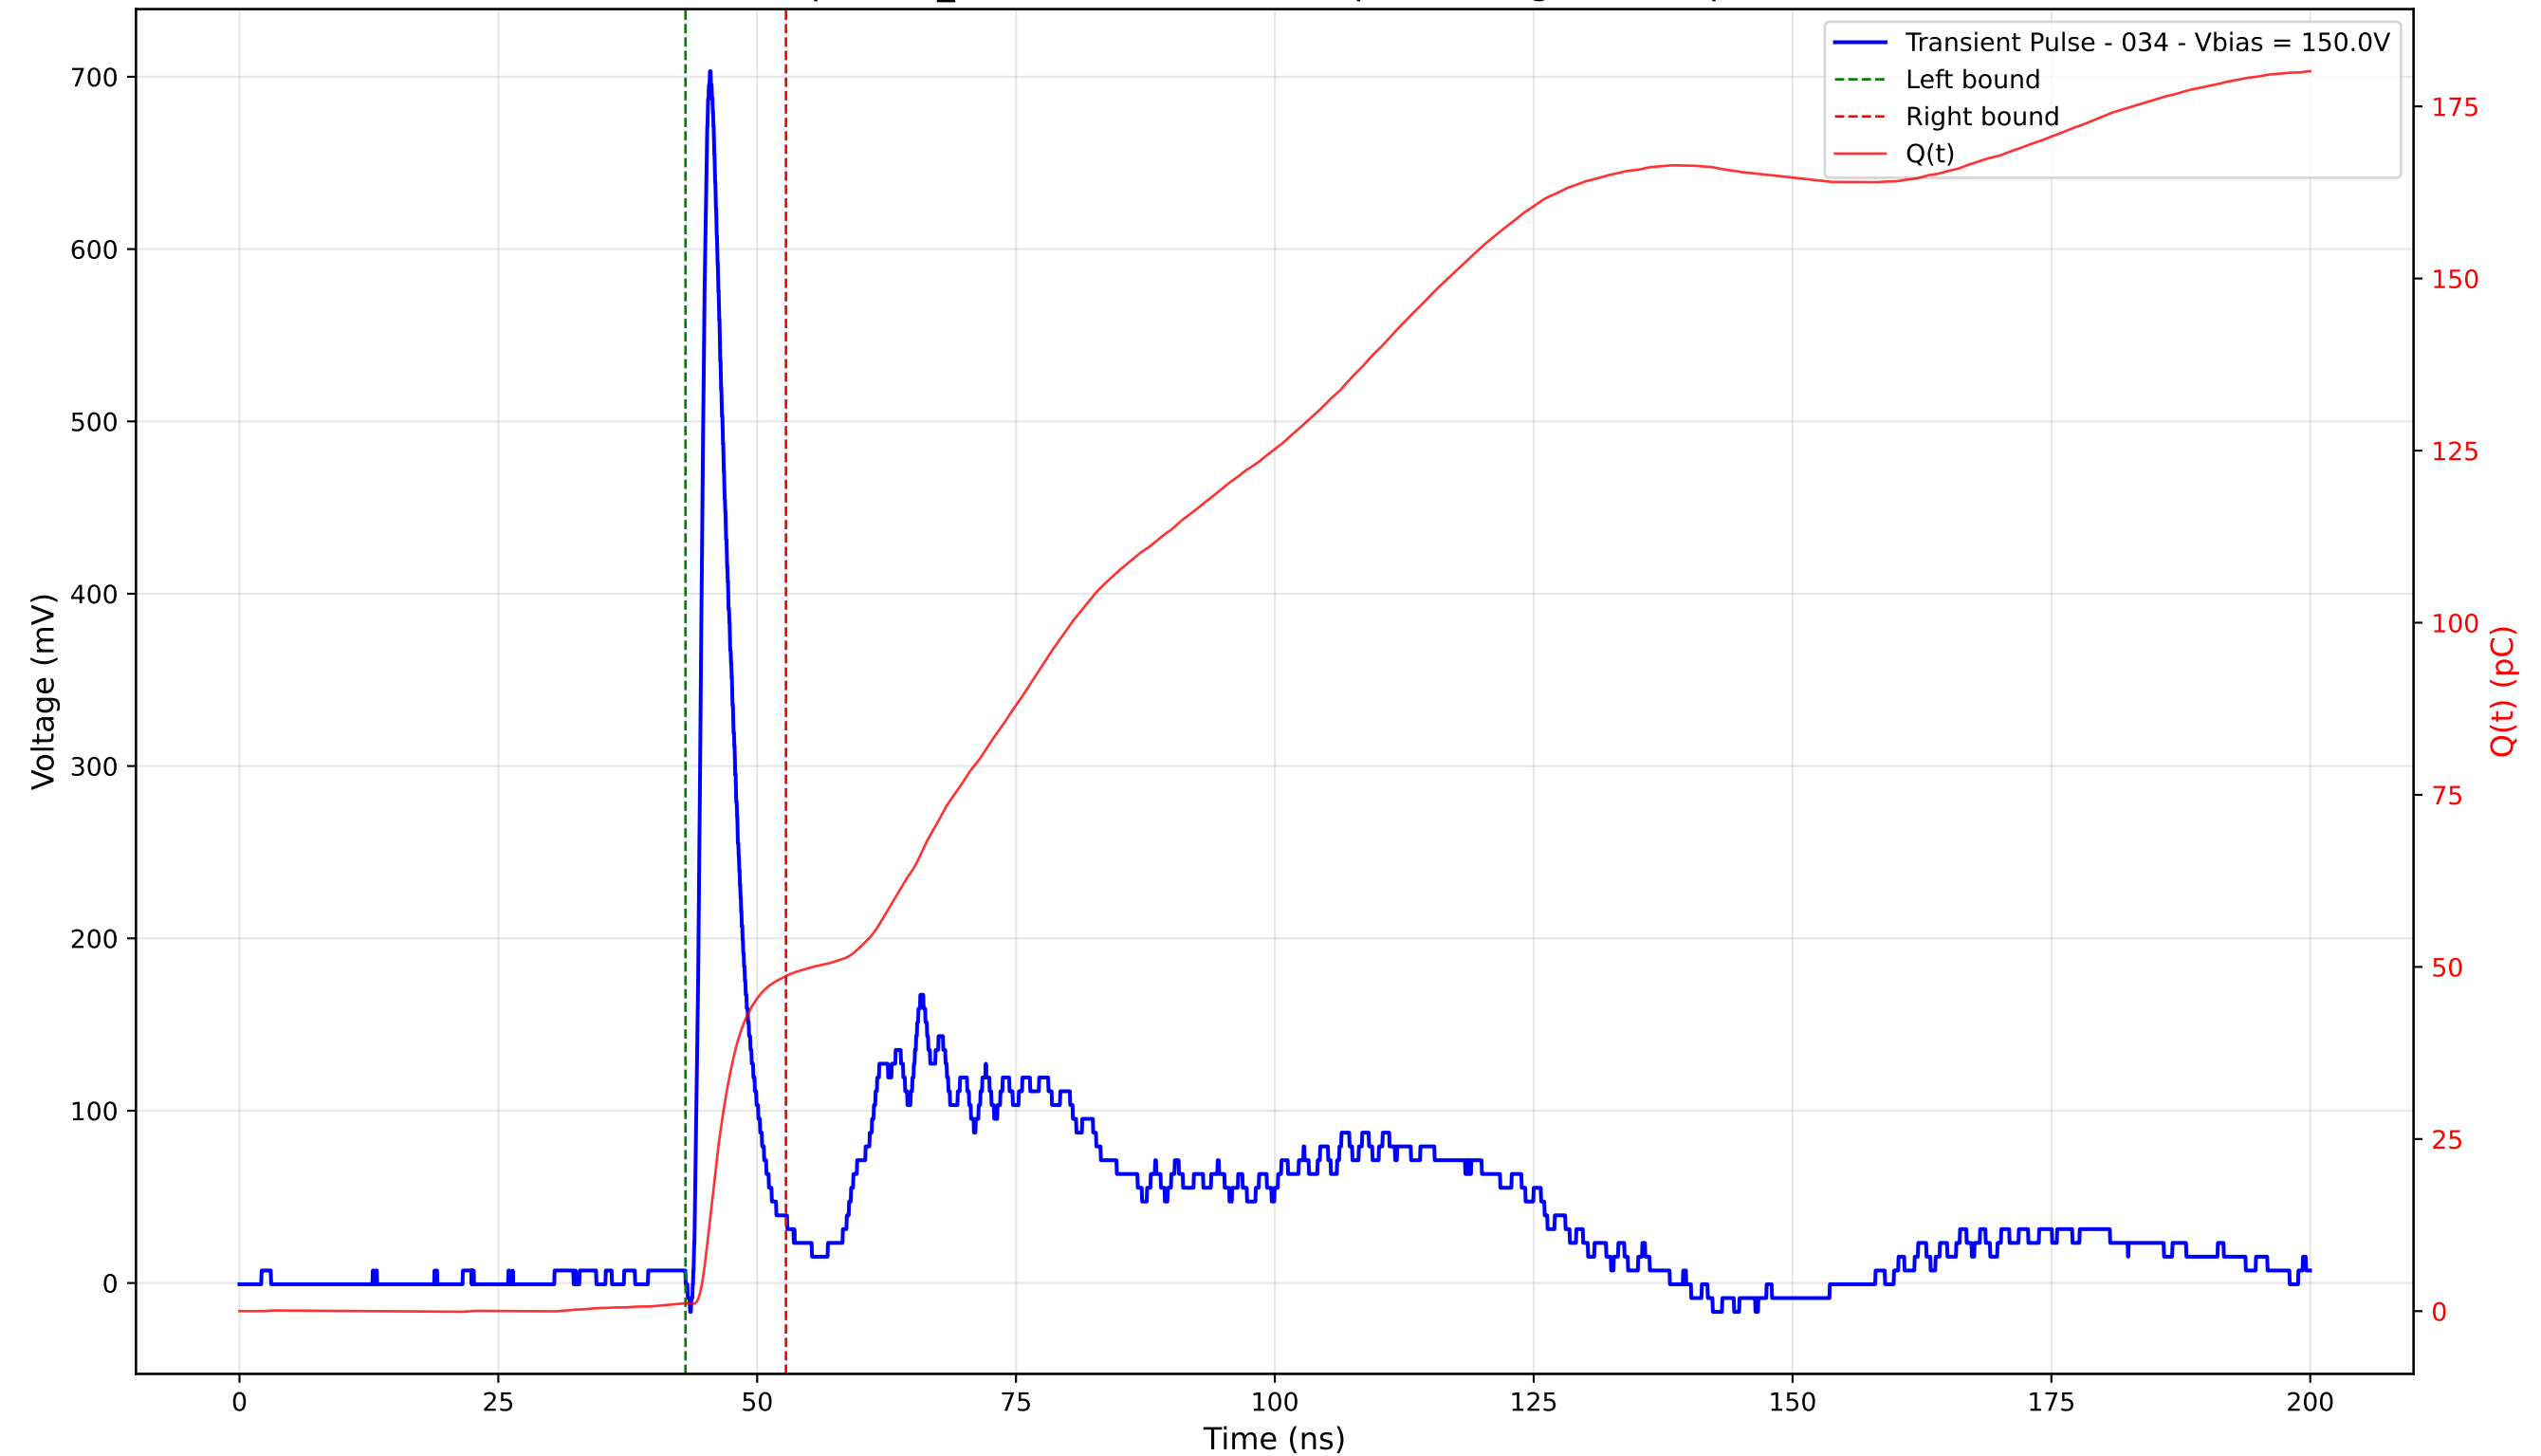


Transient Pulse - Sample: TD_4004 - Position: 135.0 μm - Charge: 46.49 pC - Rise Time: 0.99 ns

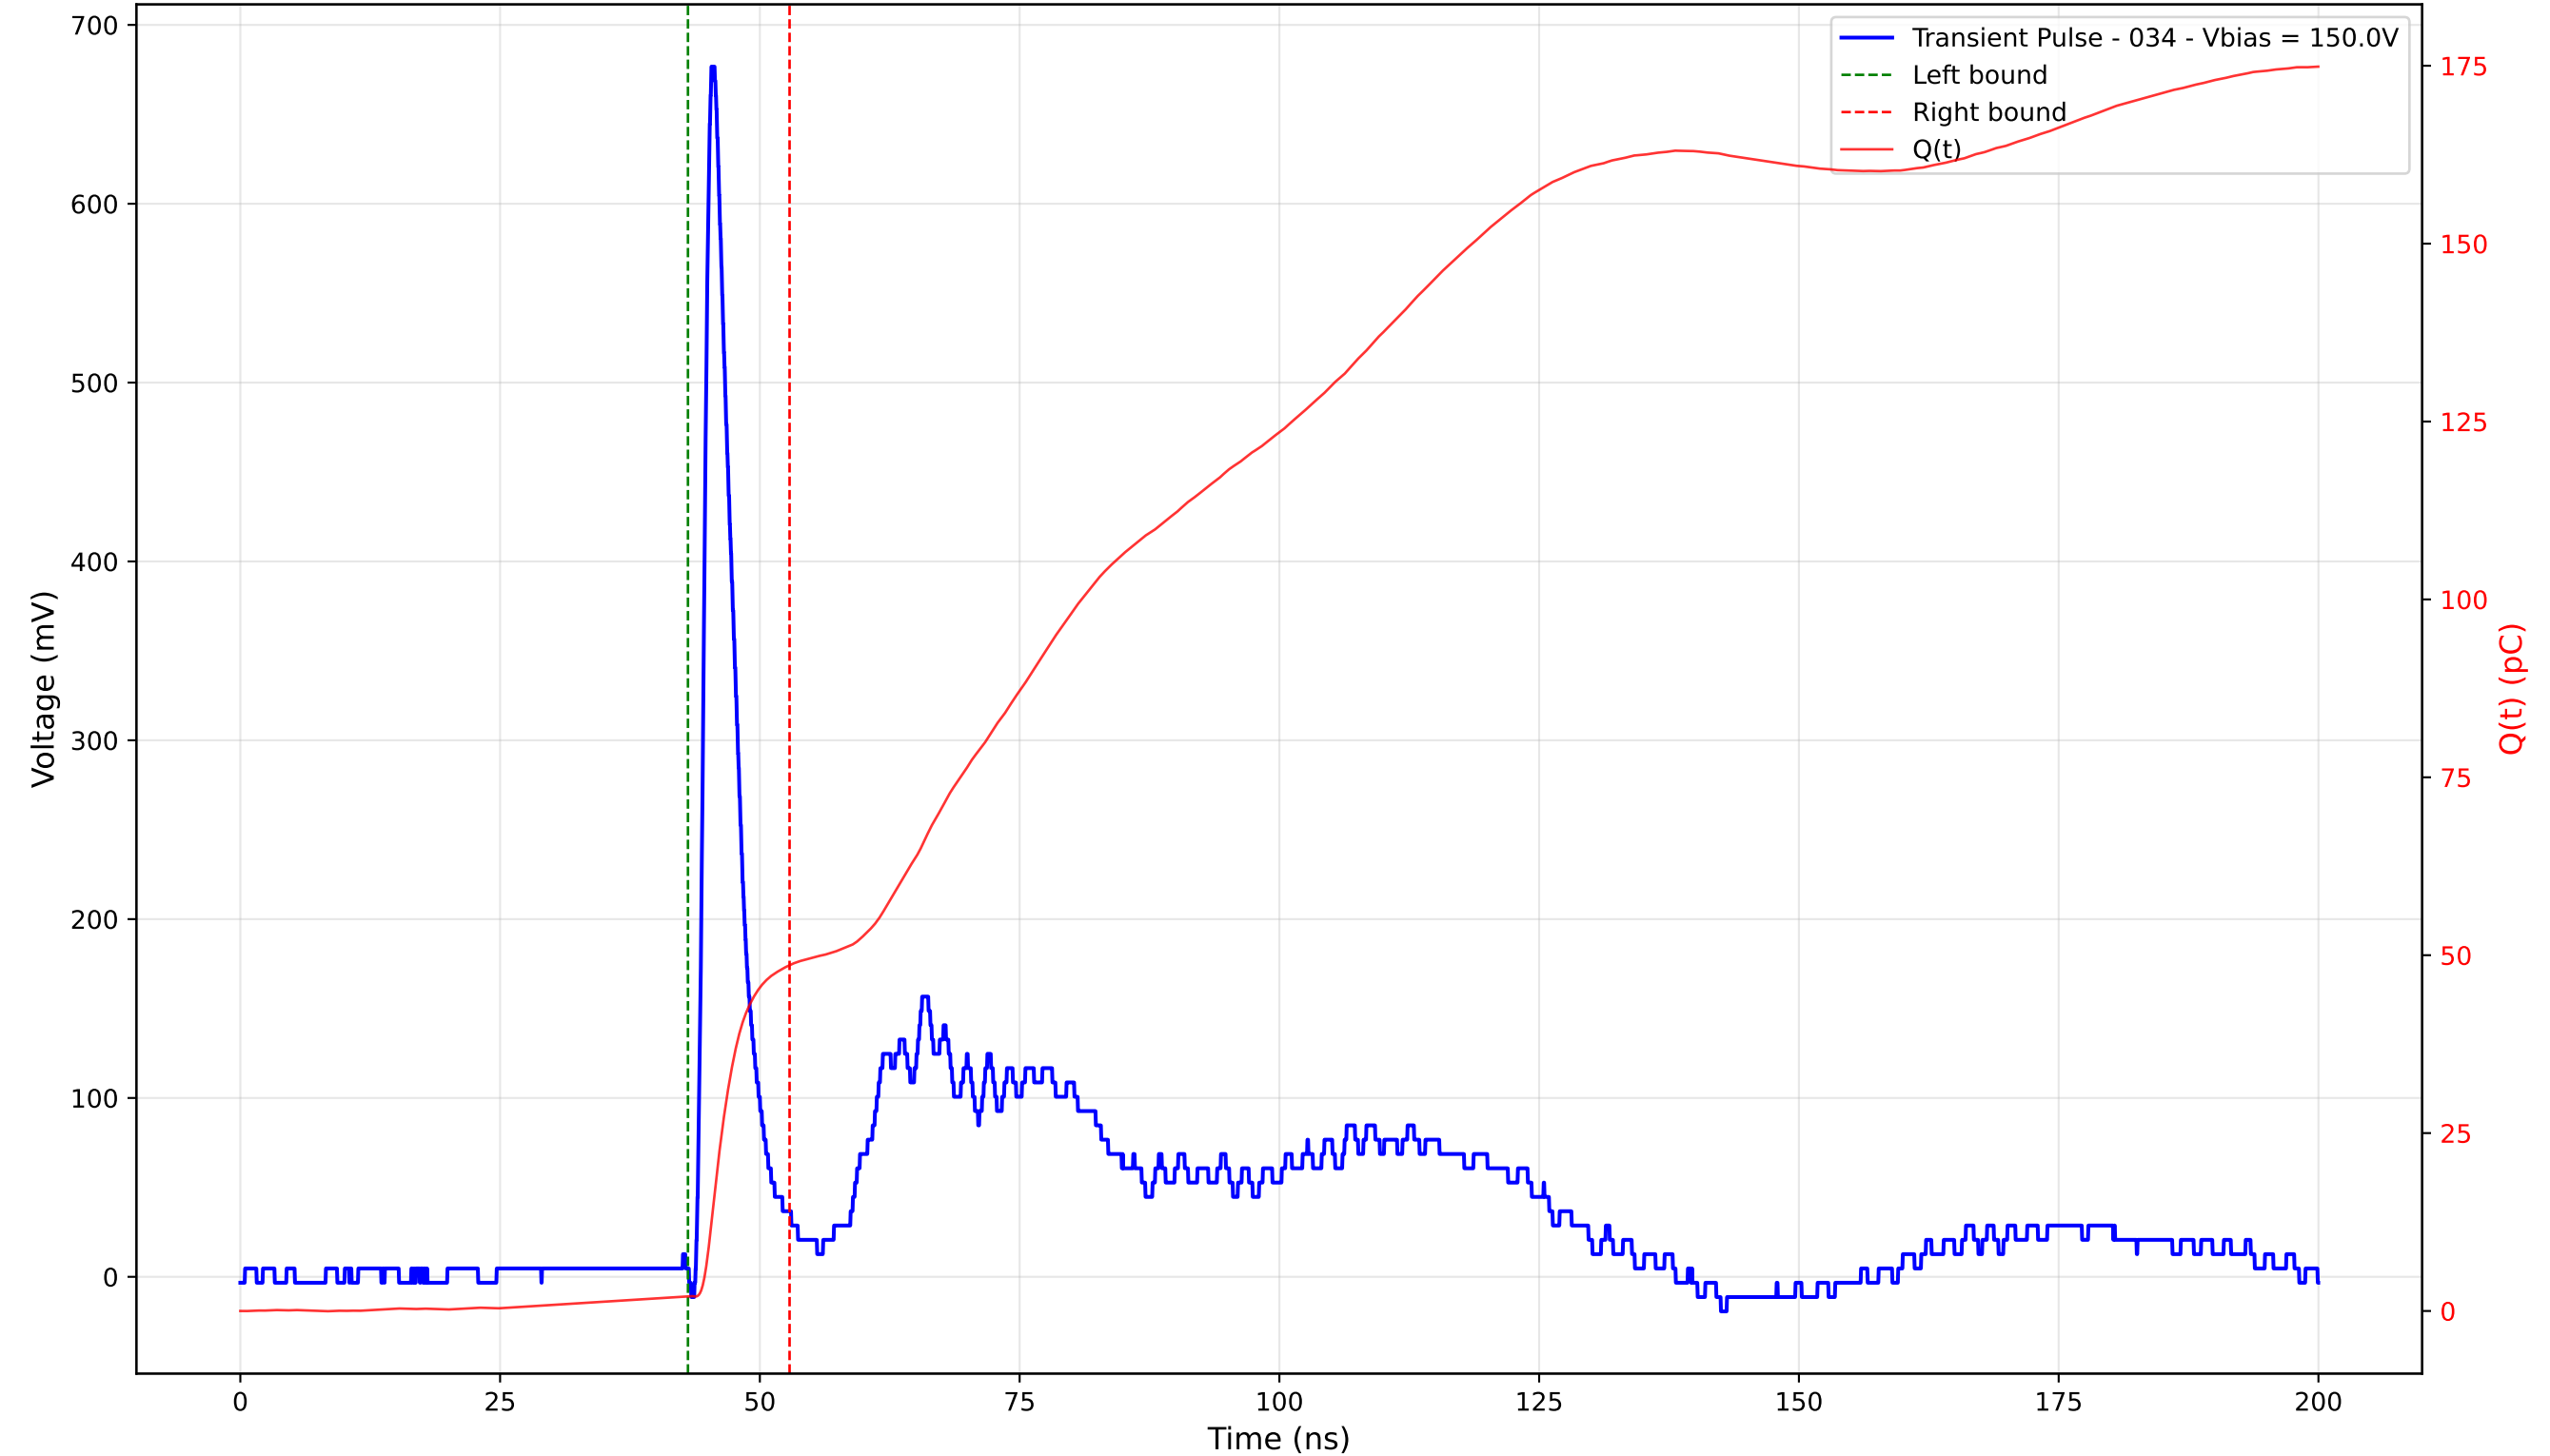


Transient Pulse - Sample: TD_4004 - Position: 140.0 μm - Charge: 45.15 pC - Rise Time: 1.01 ns

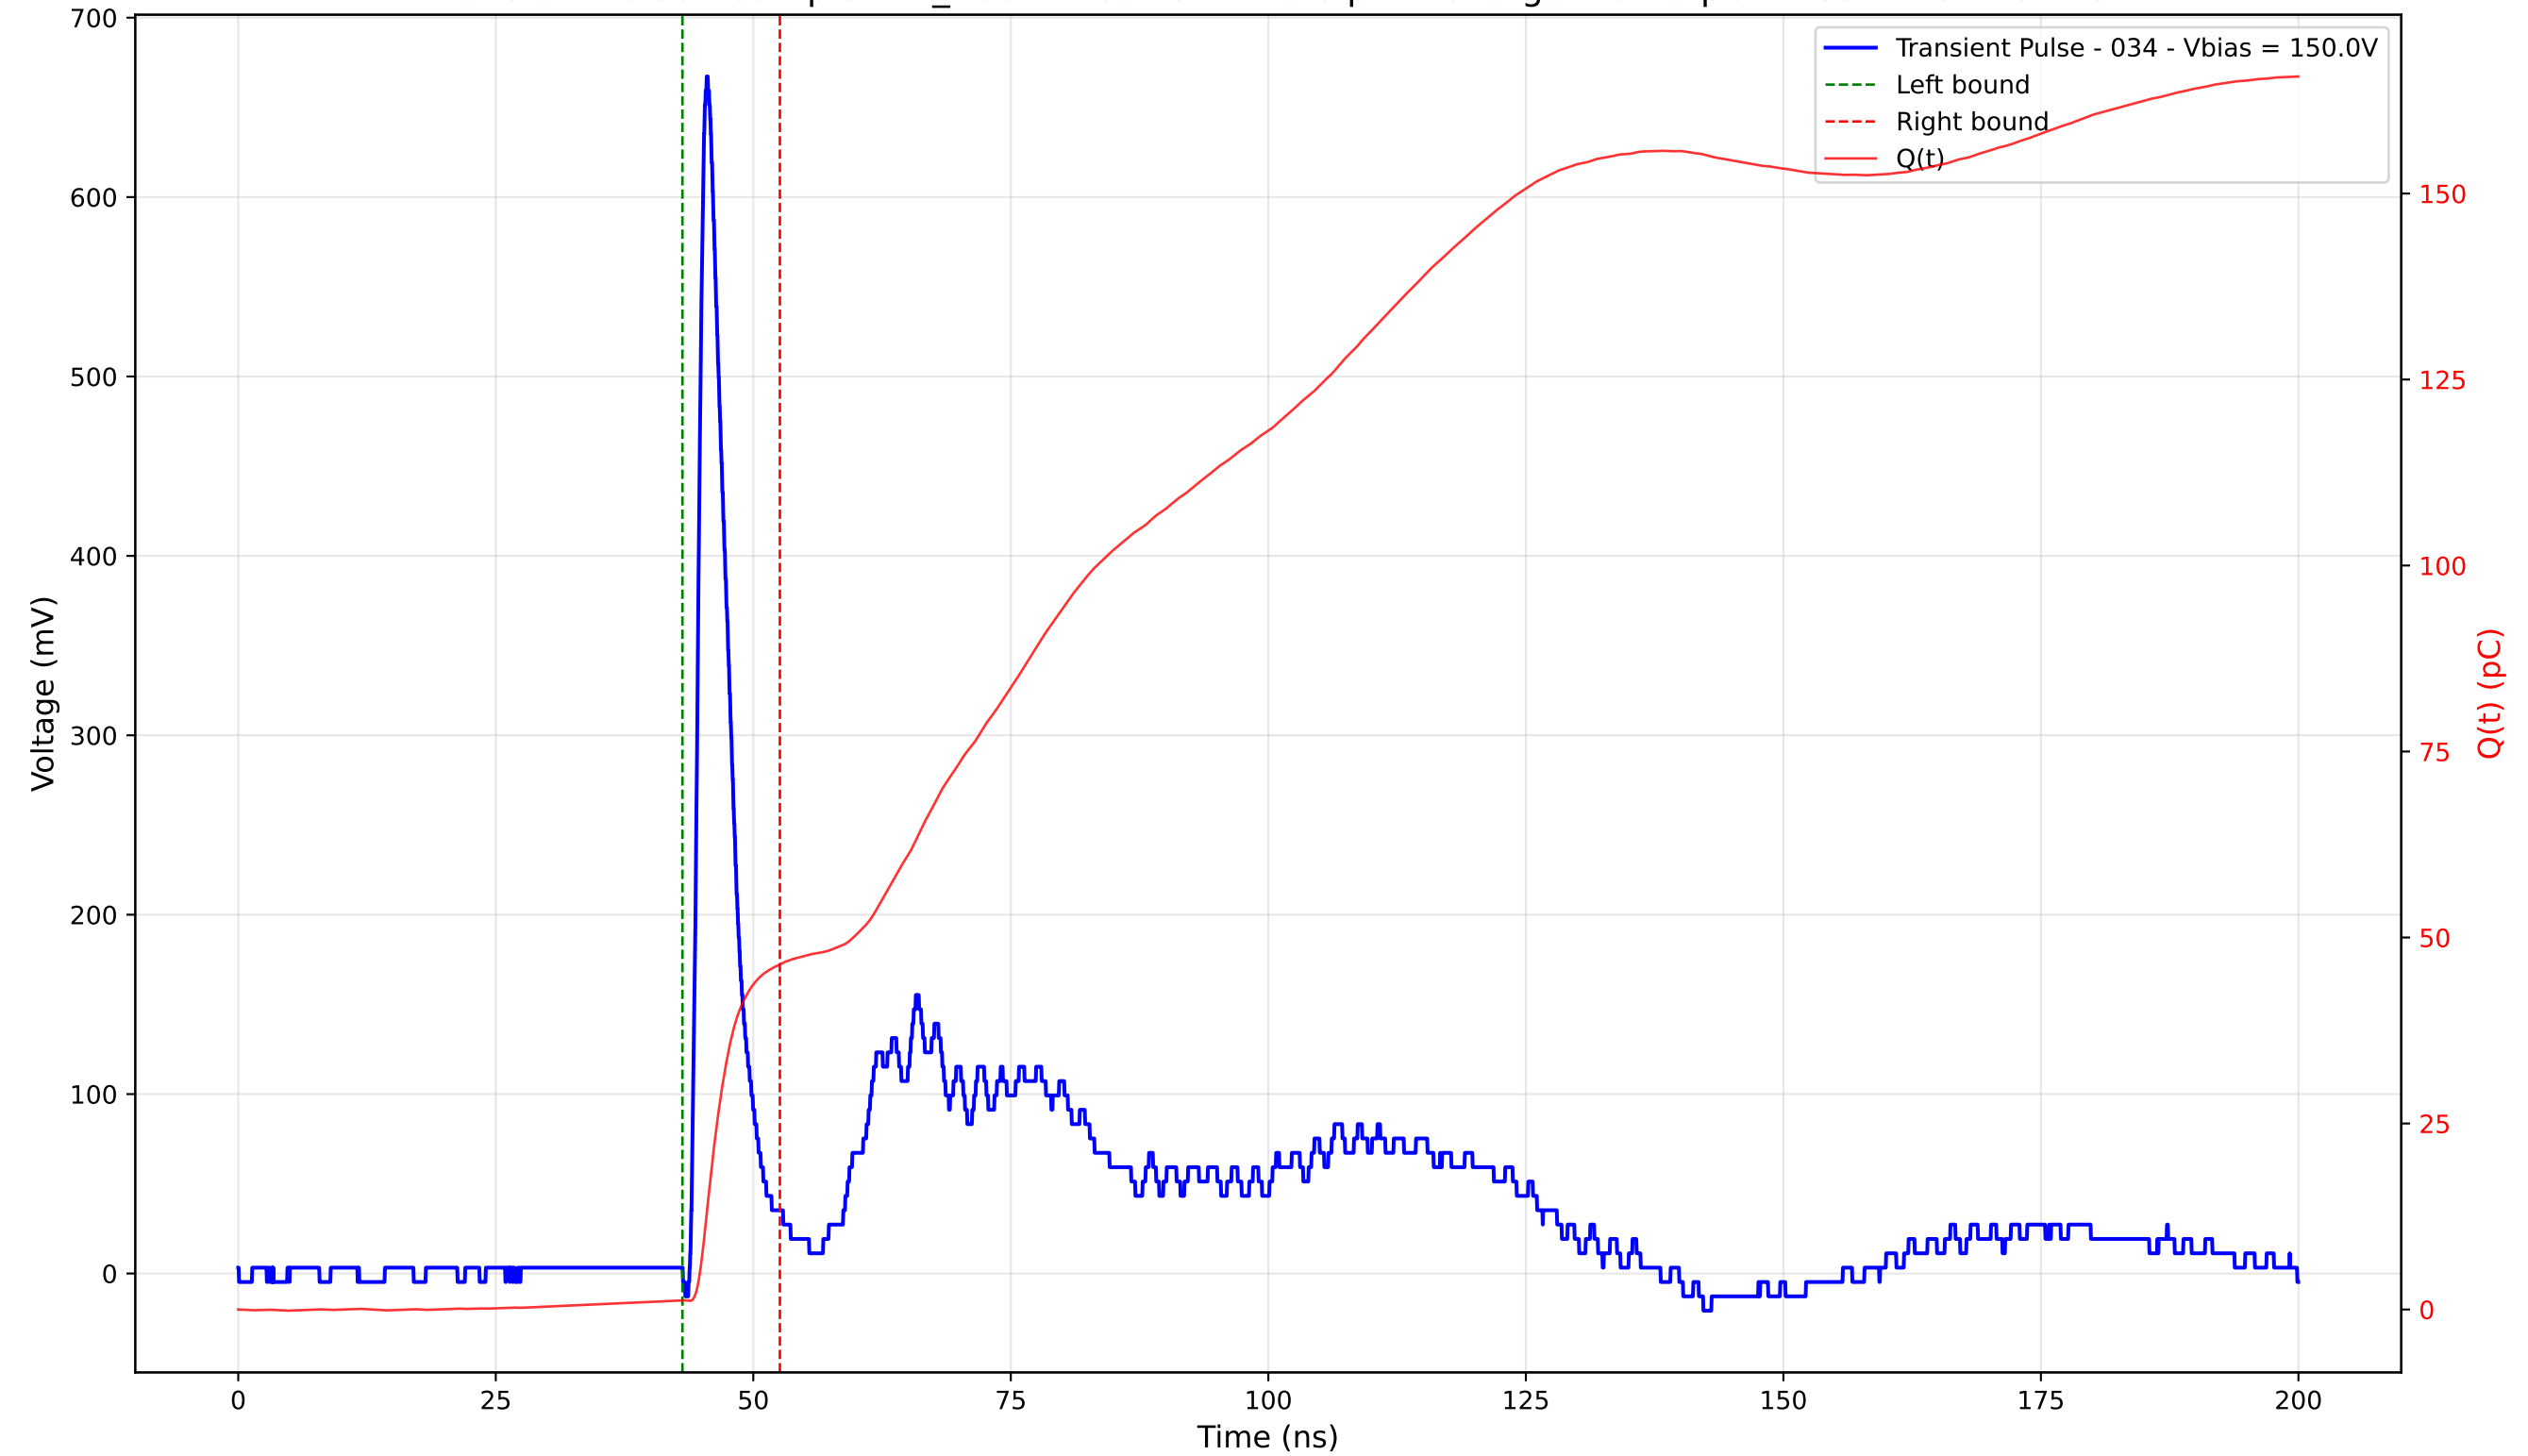


Transient Pulse - Sample: TD_4004 - Position: 145.0 μm - Charge: 44.77 pC - Rise Time: 1.00 ns

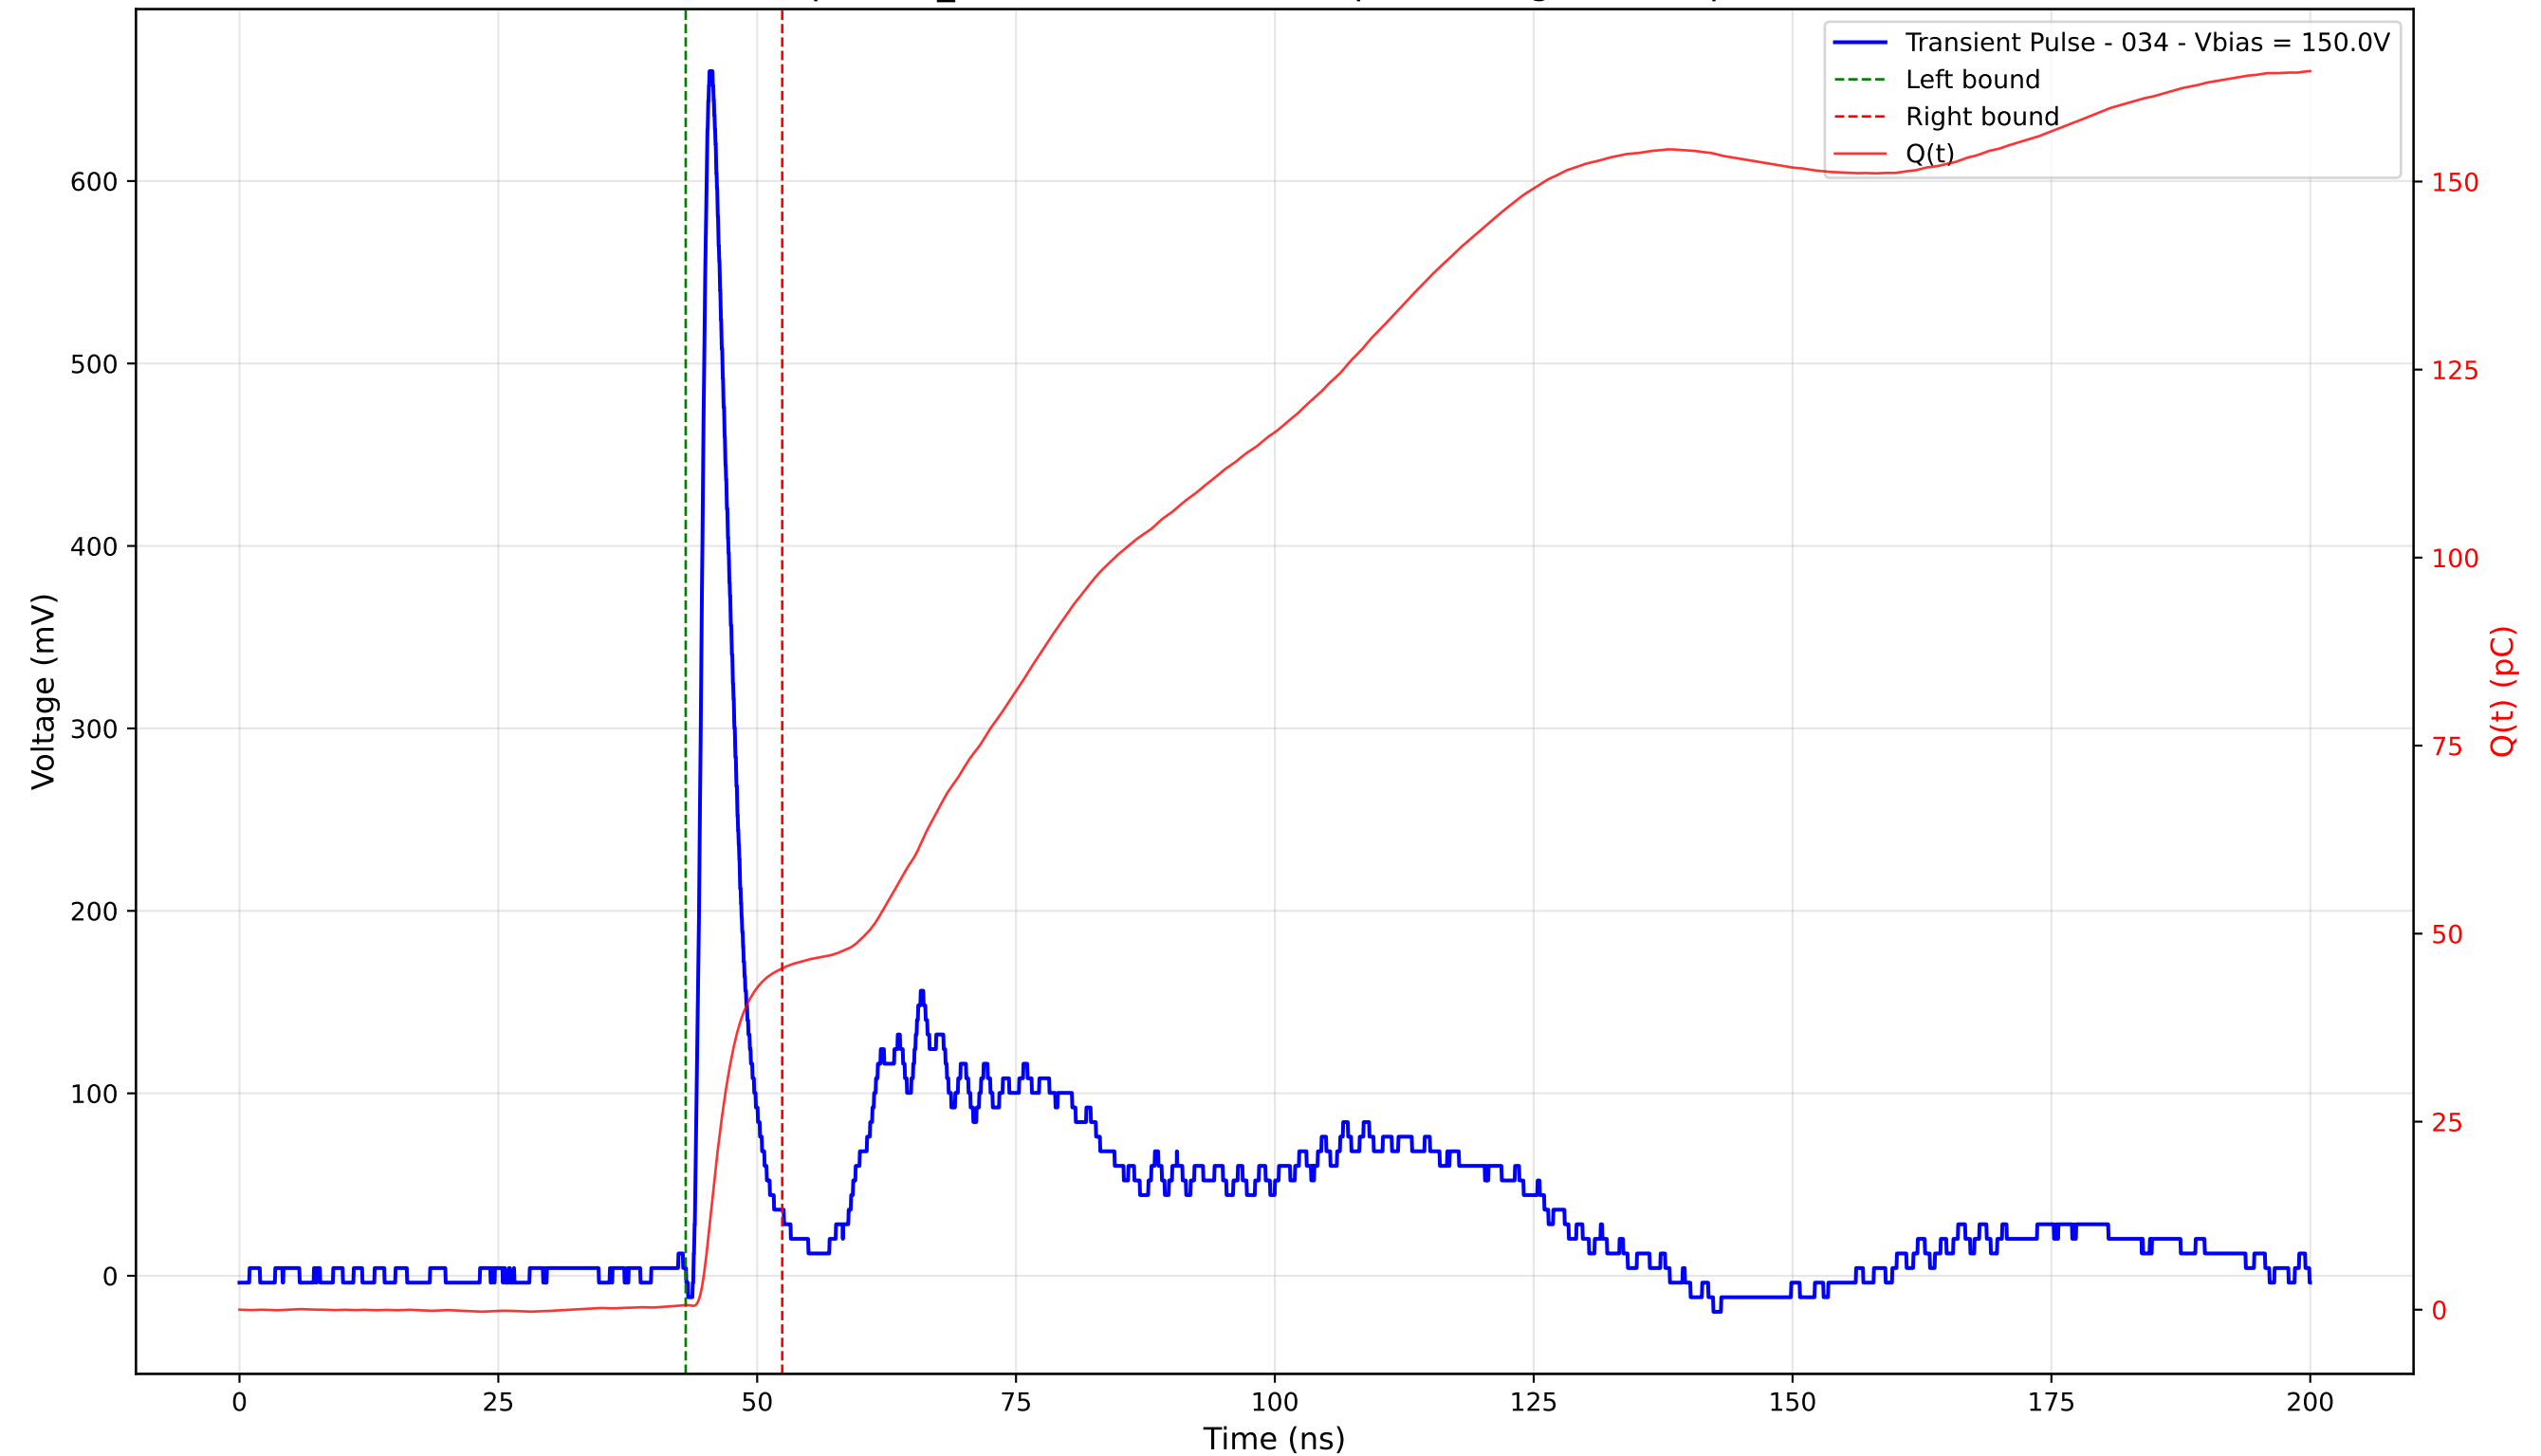


Transient Pulse - Sample: TD_4004 - Position: 150.0 μm - Charge: 44.94 pC - Rise Time: 0.99 ns

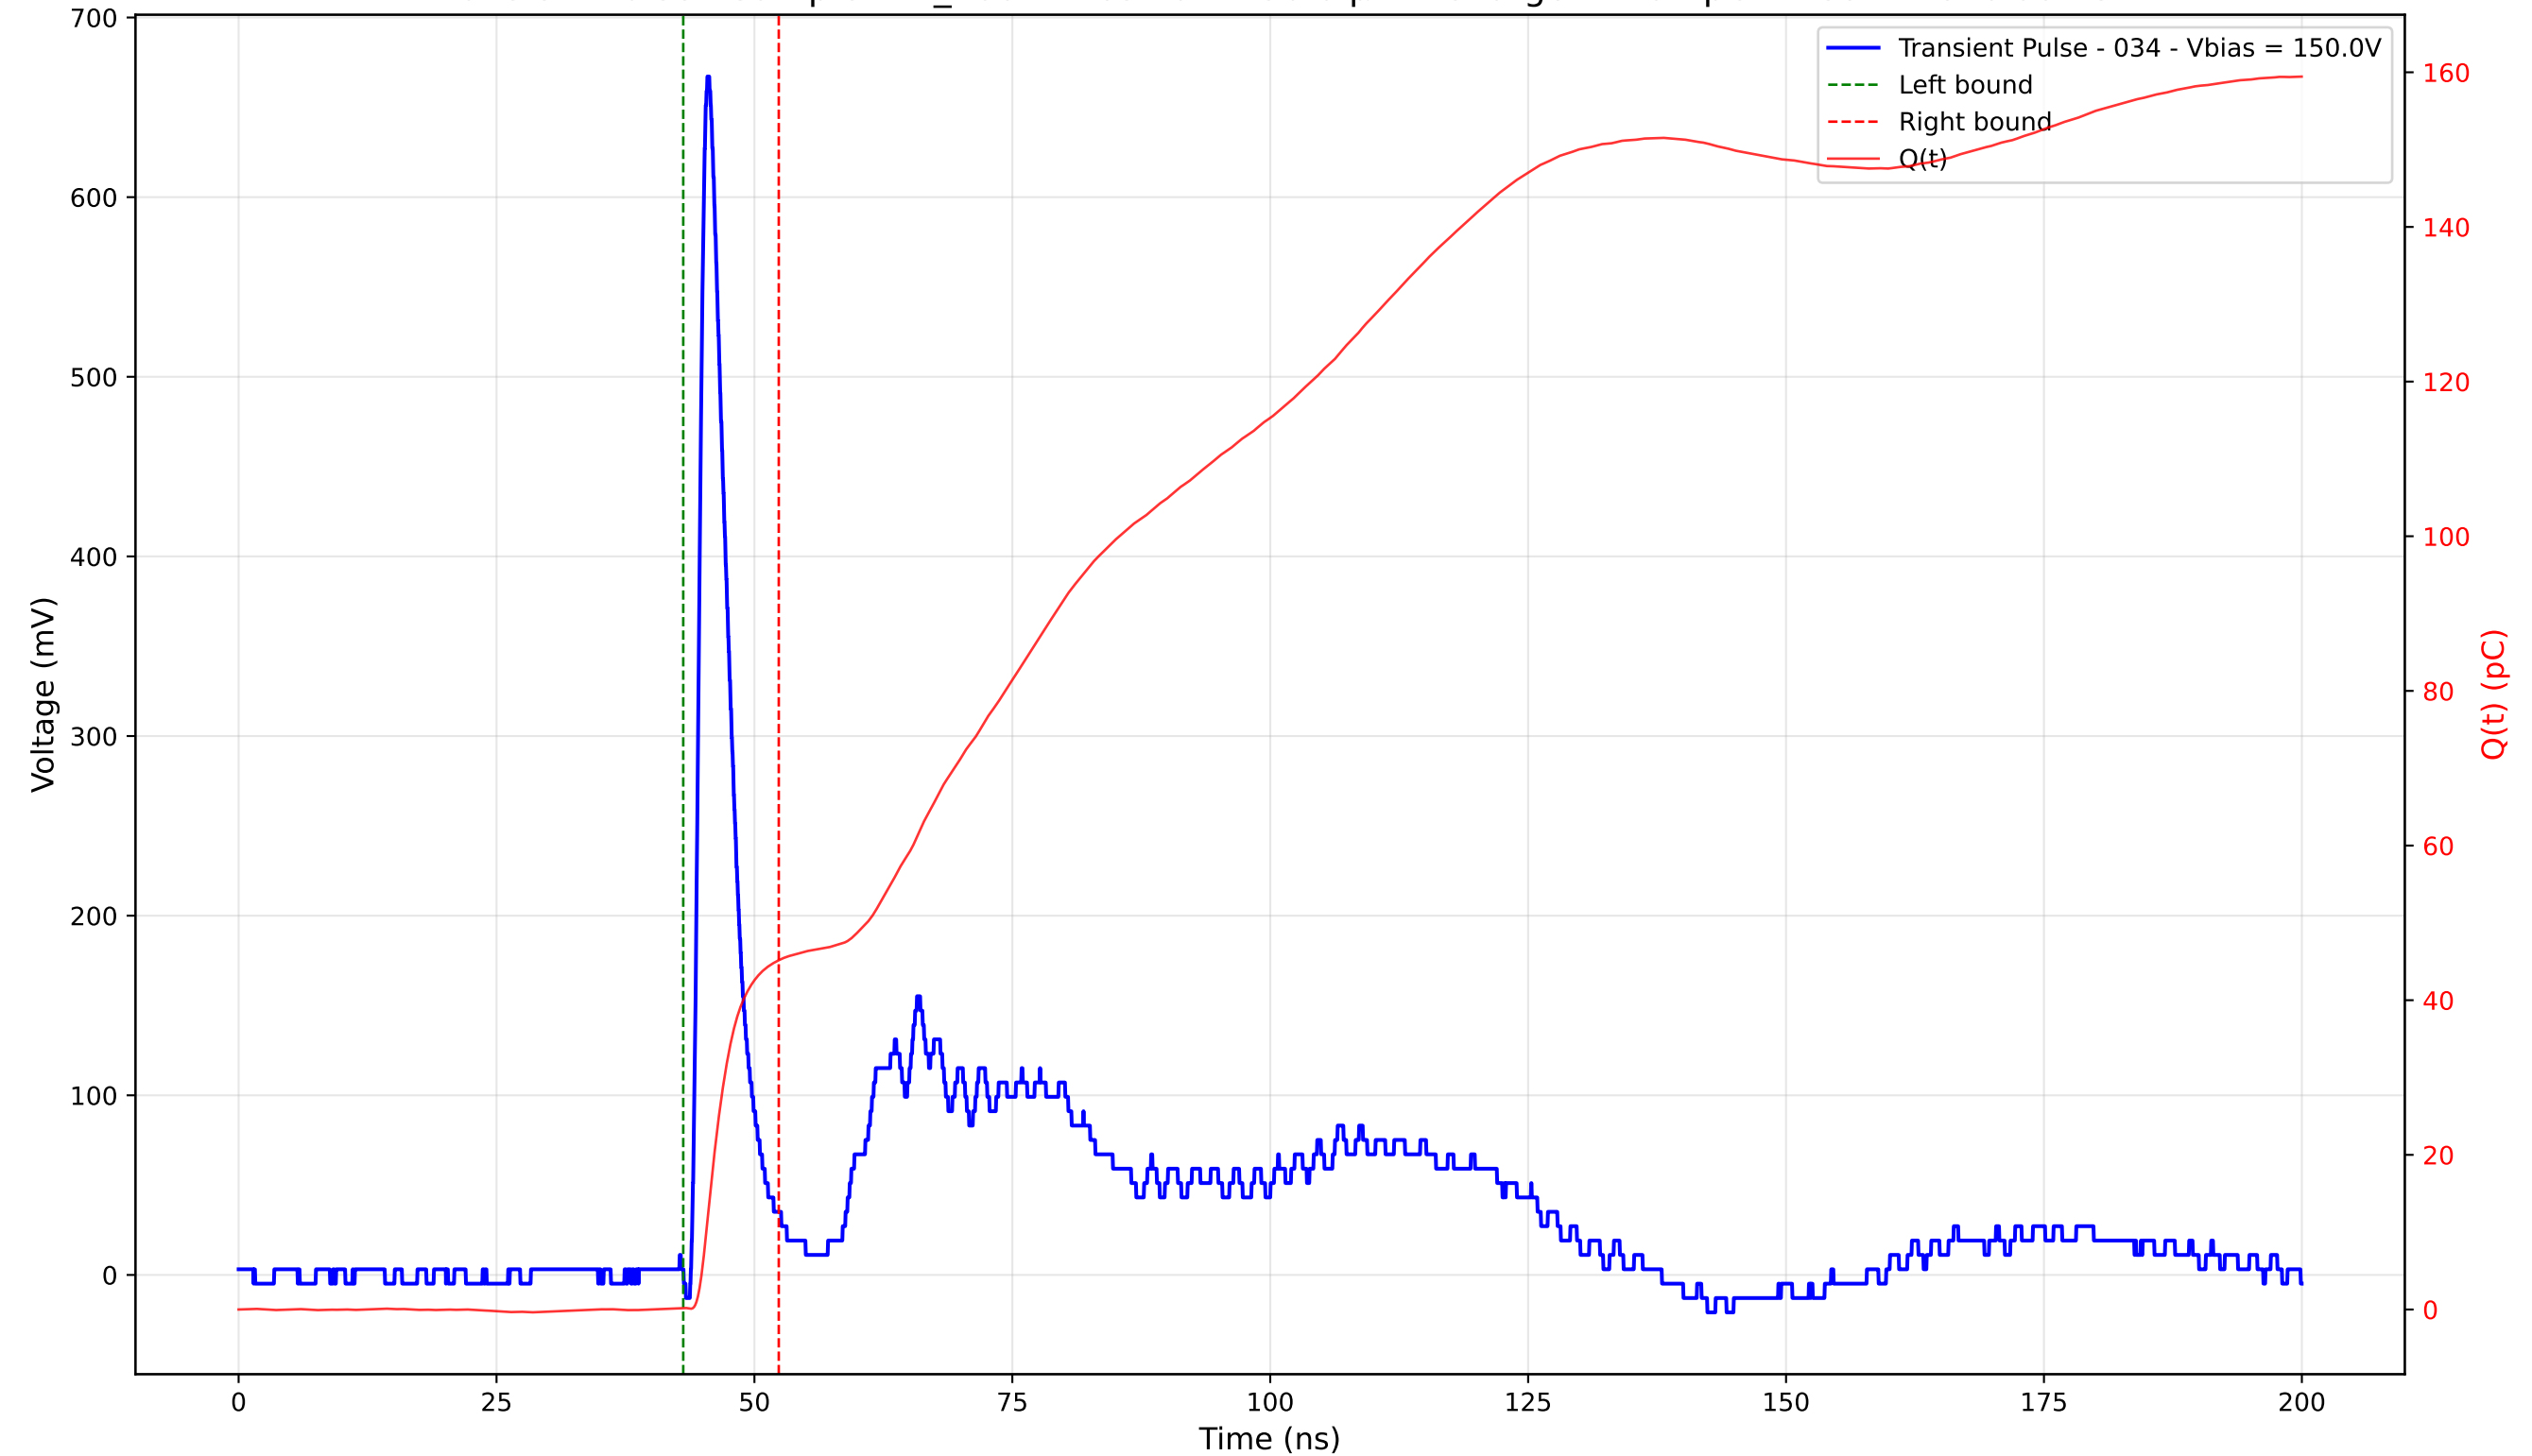


Transient Pulse - Sample: TD_4004 - Position: 155.0 μm - Charge: 45.89 pC - Rise Time: 0.99 ns

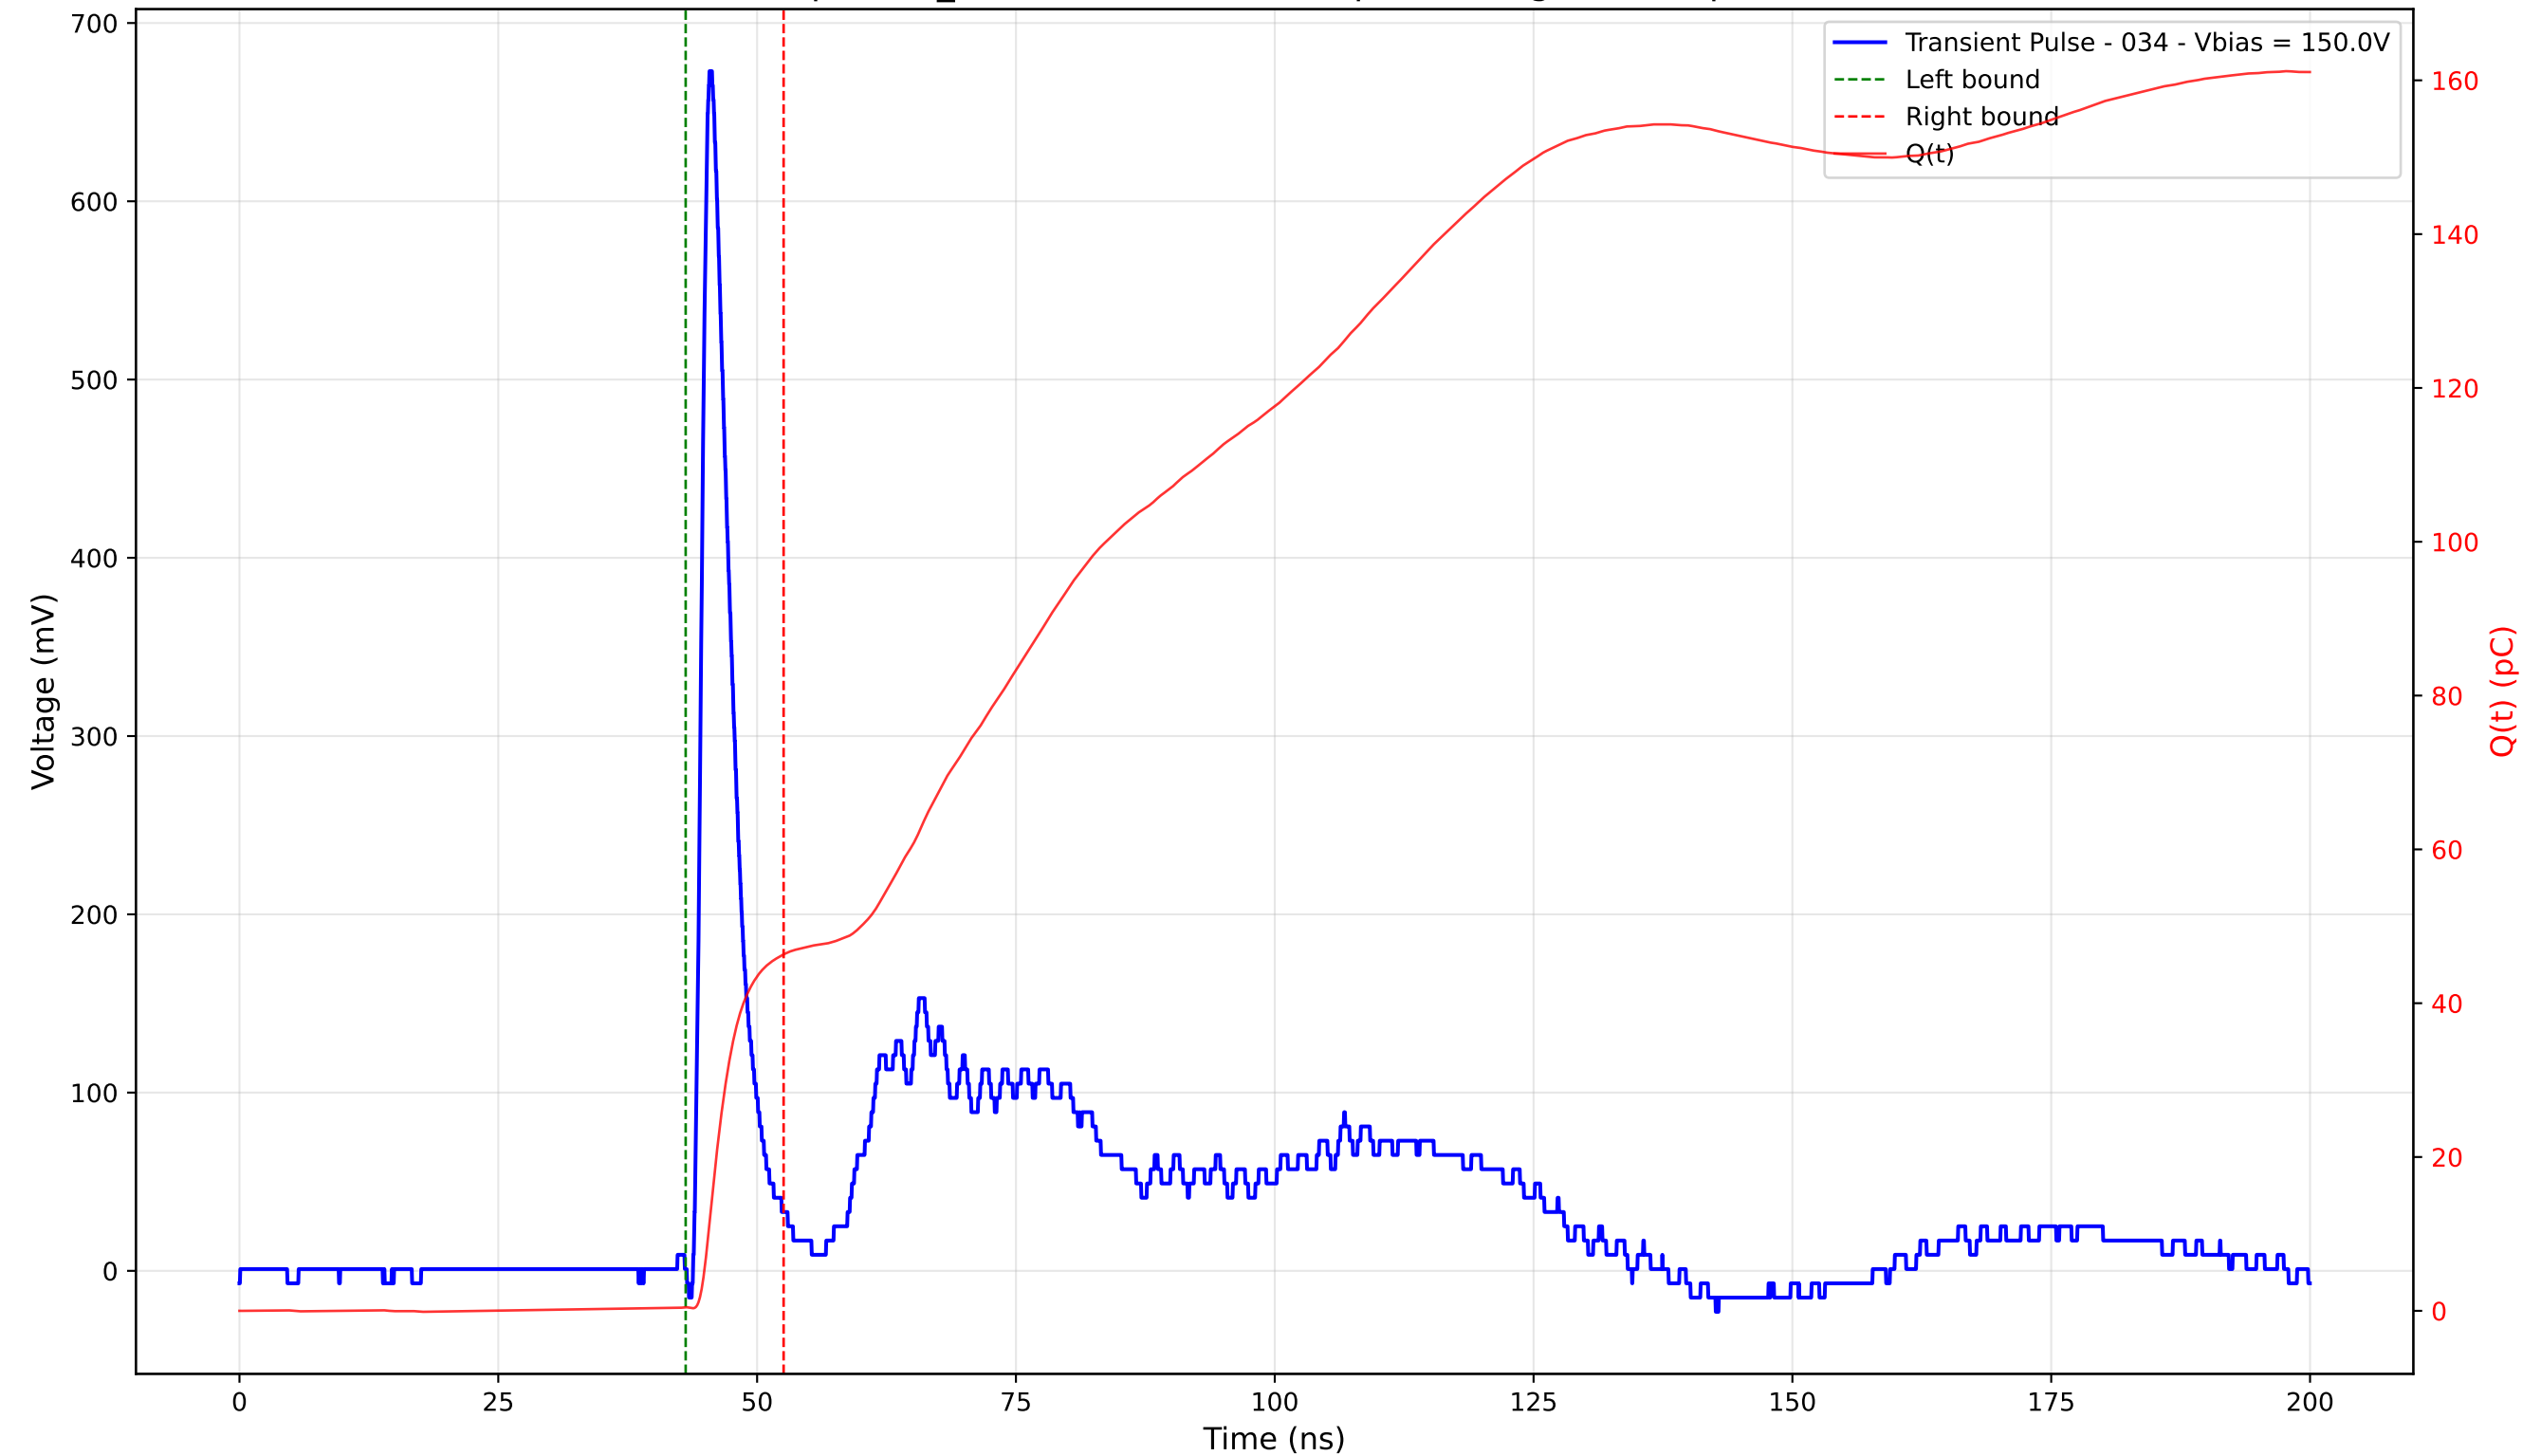


Transient Pulse - Sample: TD_4004 - Position: 160.0 μm - Charge: 47.68 pC - Rise Time: 0.99 ns

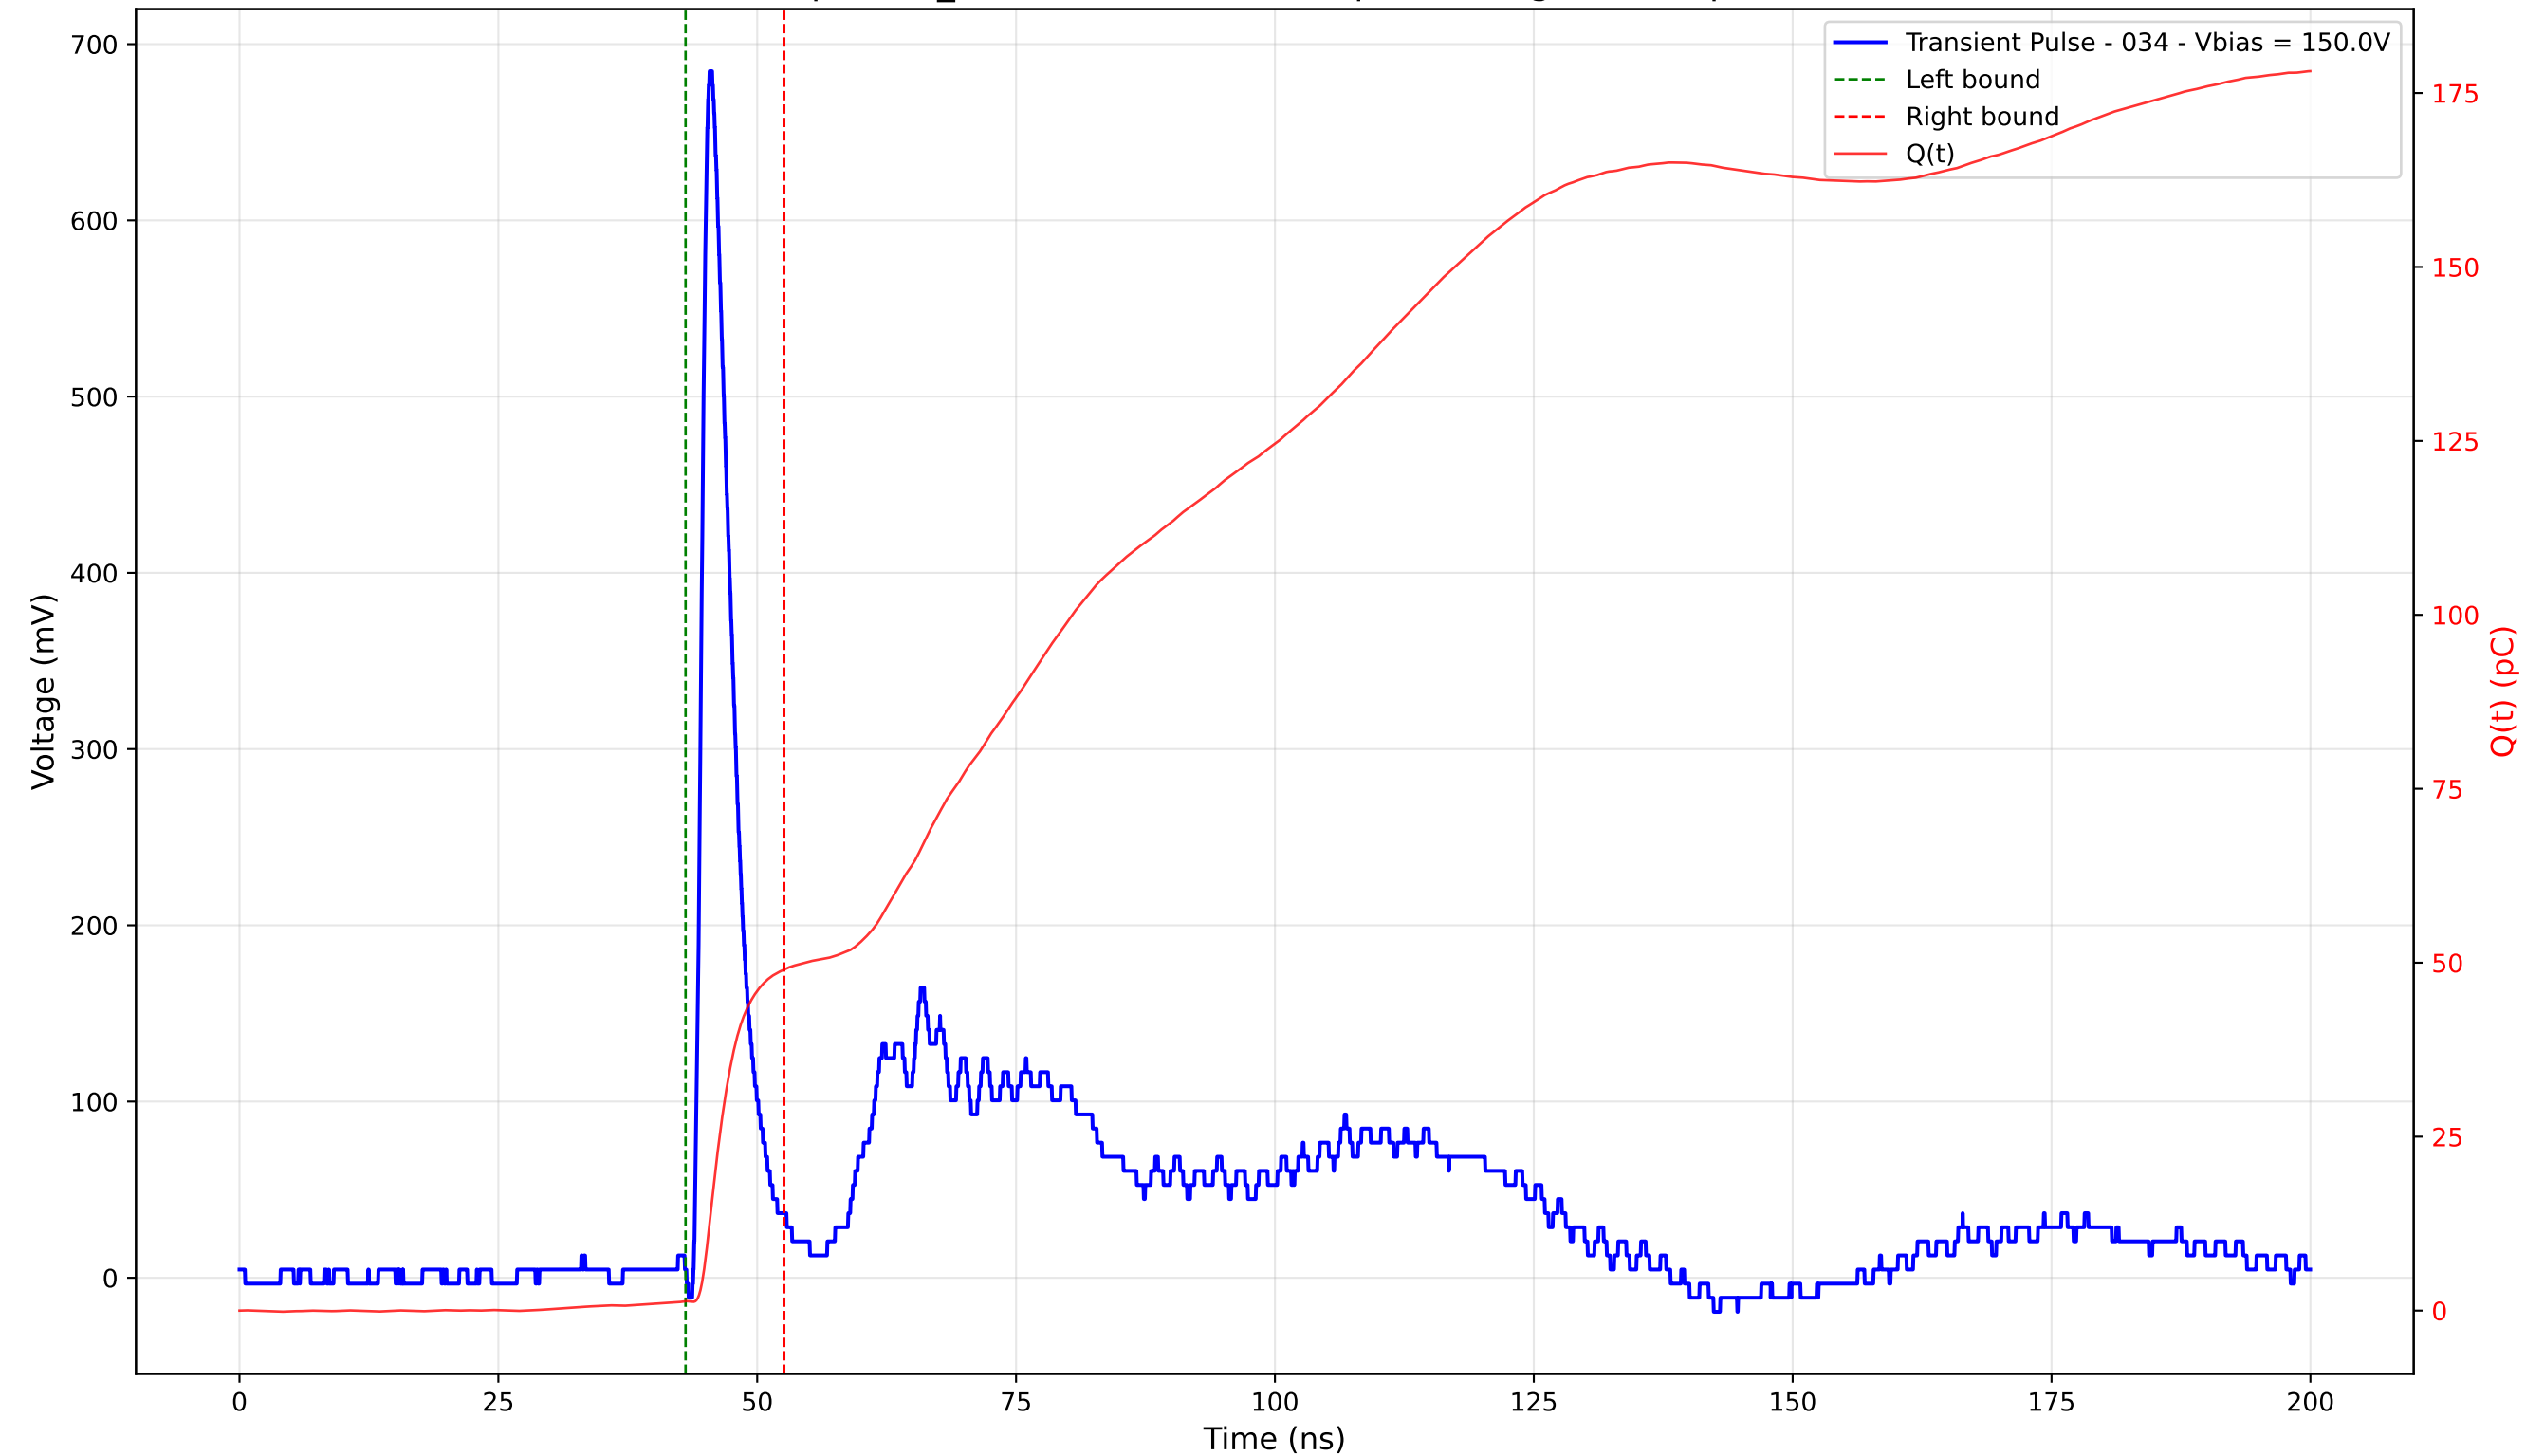


Transient Pulse - Sample: TD_4004 - Position: 165.0 μm - Charge: 49.59 pC - Rise Time: 0.98 ns

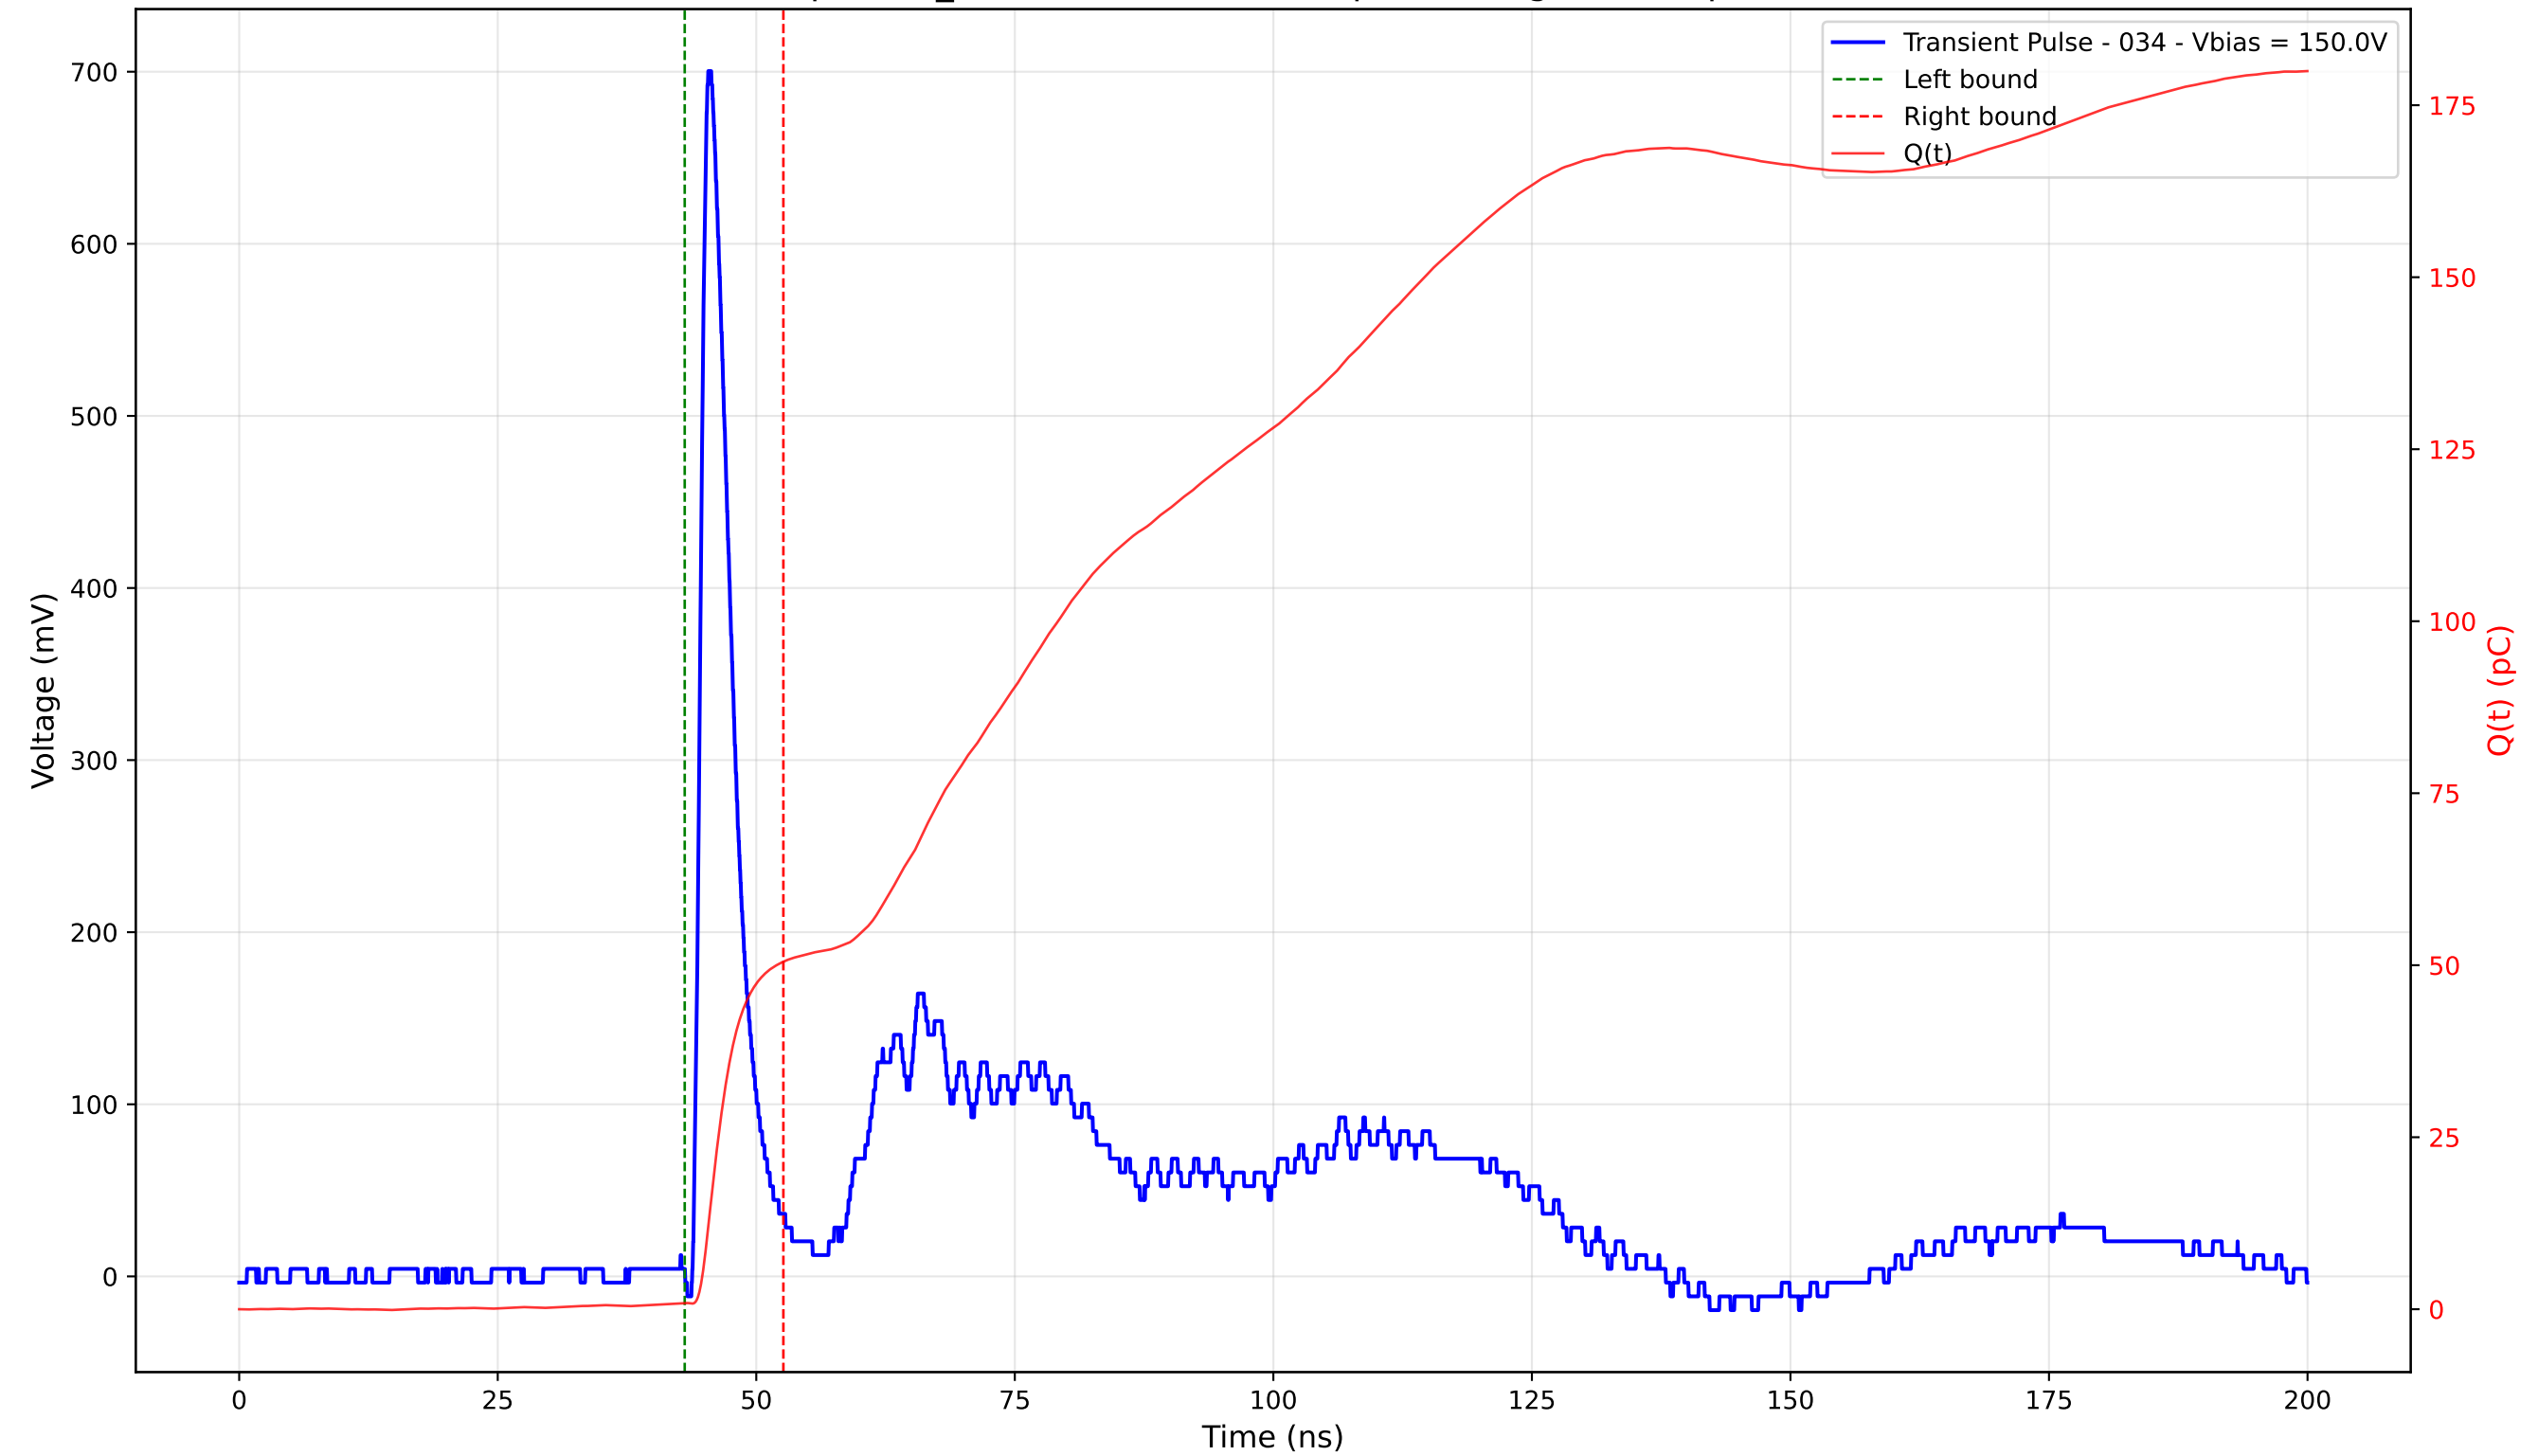


Transient Pulse - Sample: TD_4004 - Position: 170.0 μm - Charge: 51.28 pC - Rise Time: 0.96 ns

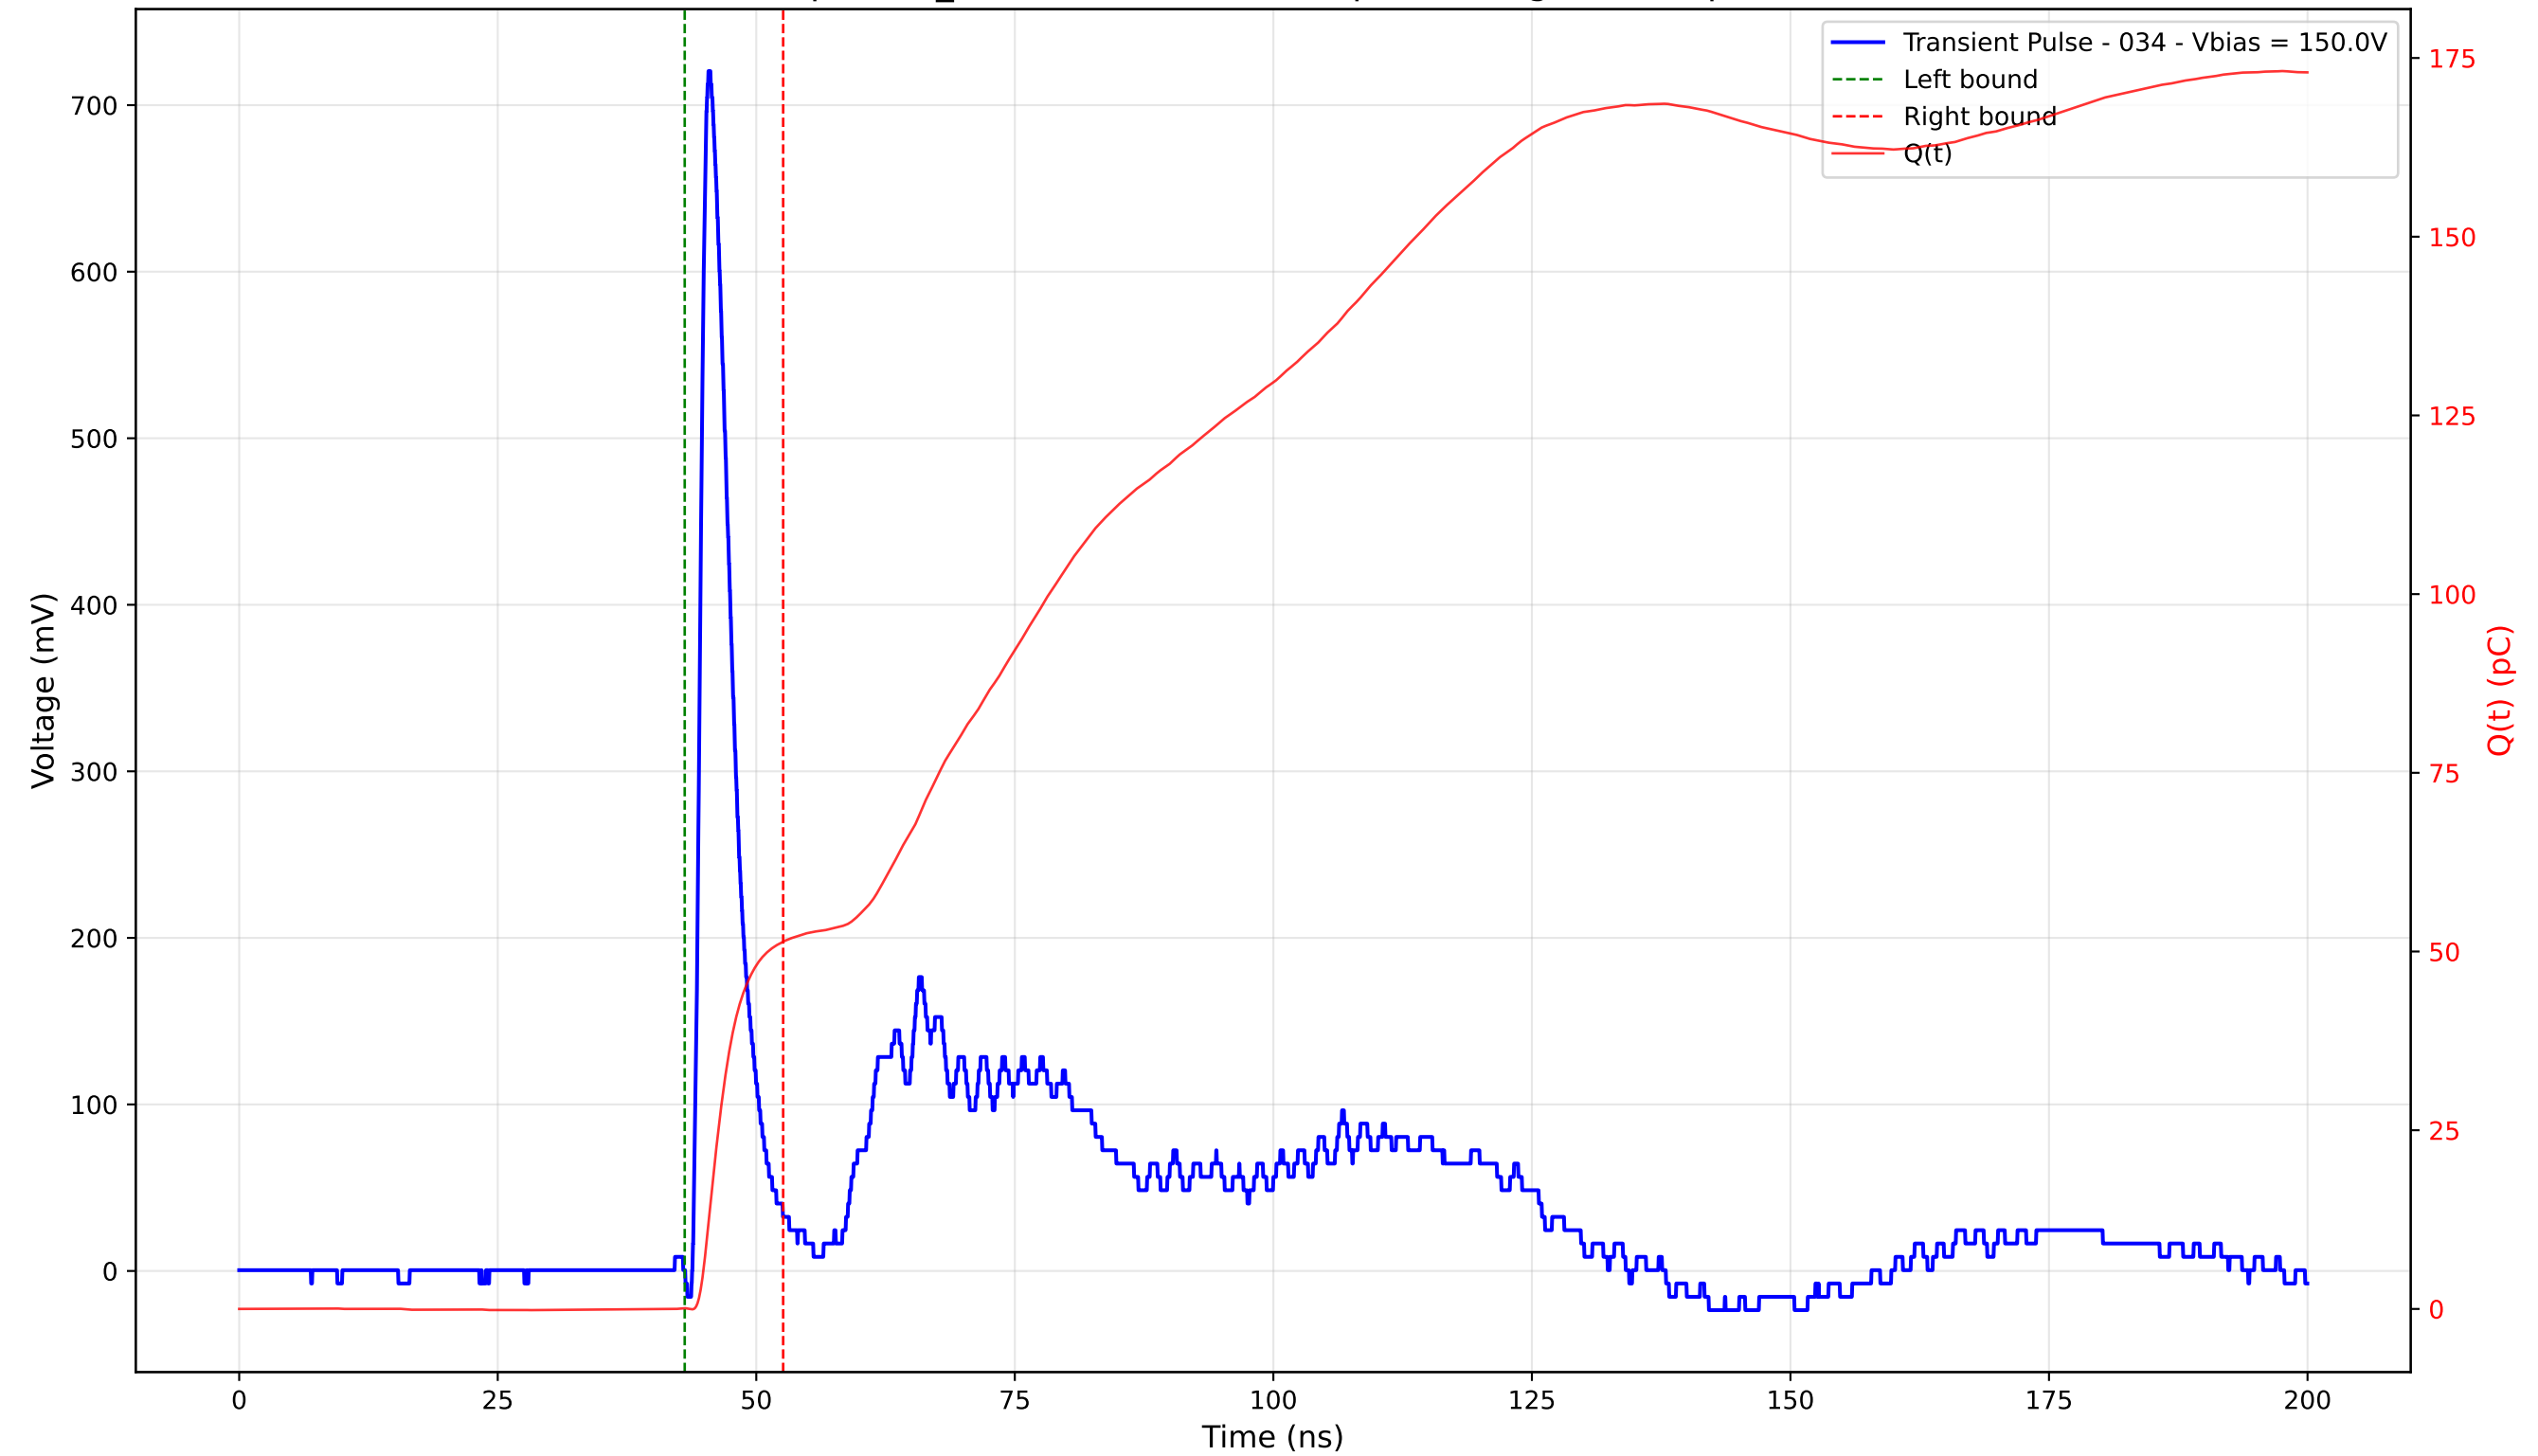


Transient Pulse - Sample: TD_4004 - Position: 175.0 μm - Charge: 53.29 pC - Rise Time: 0.96 ns

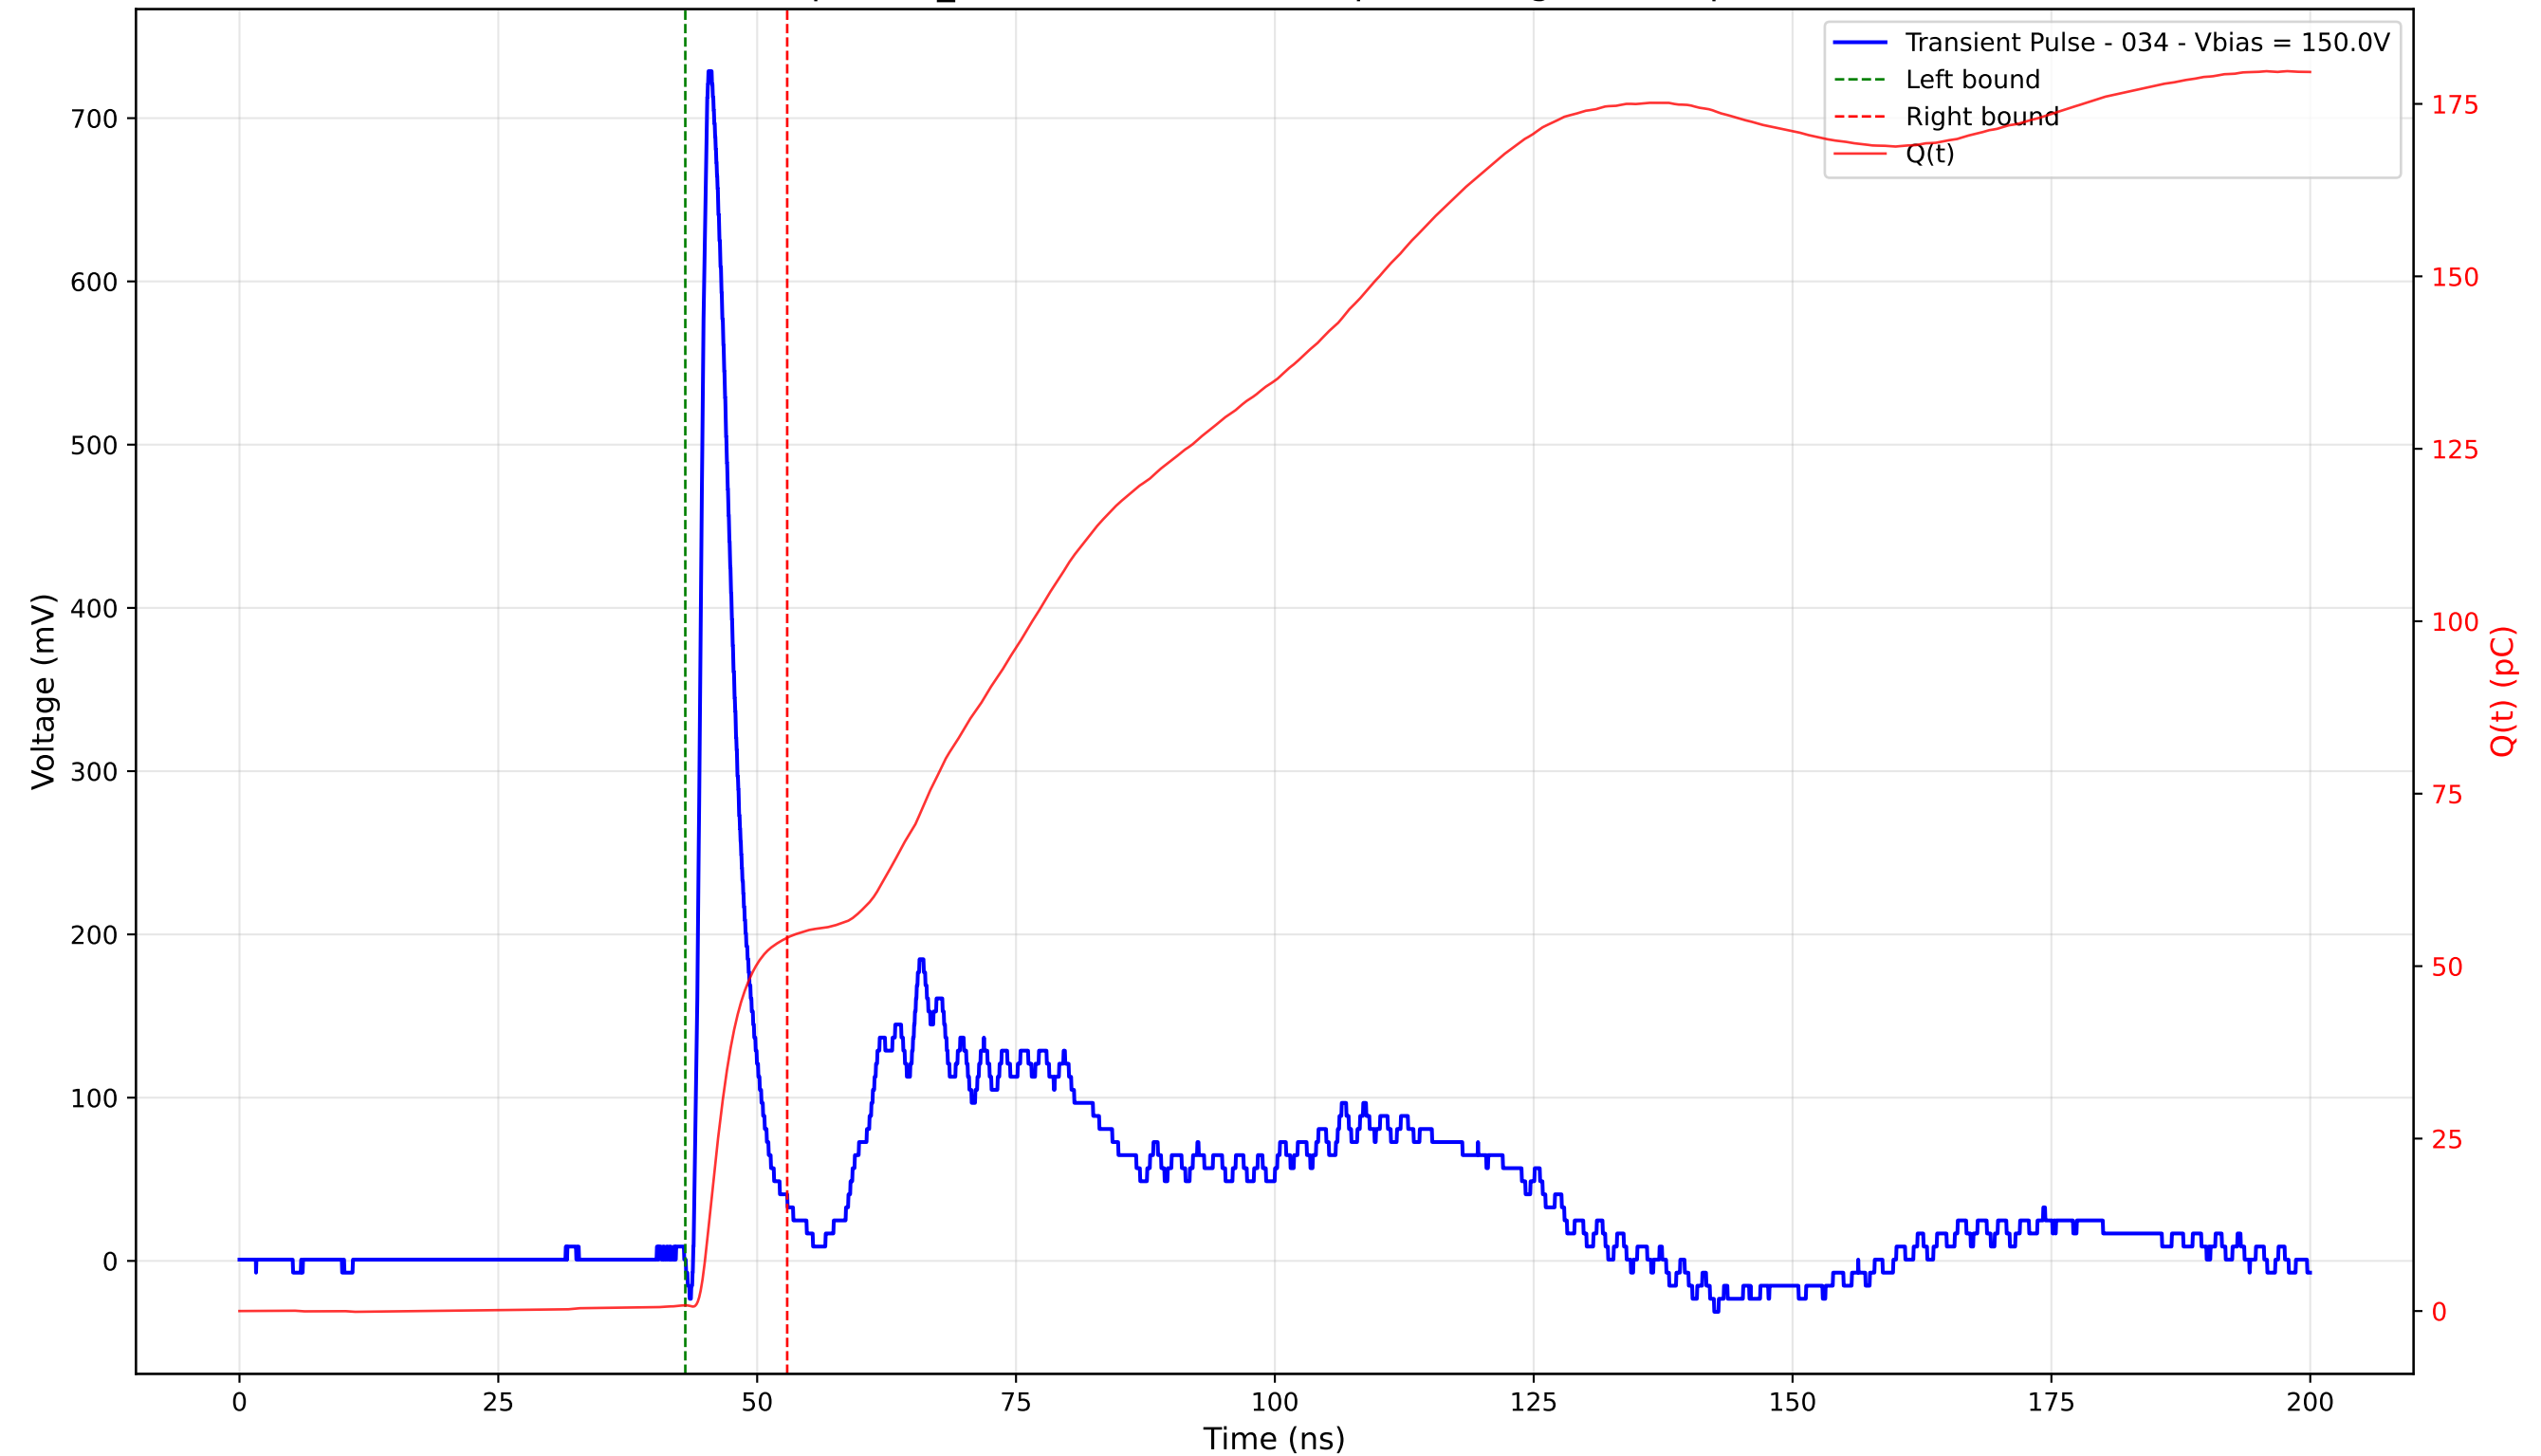


Transient Pulse - Sample: TD_4004 - Position: 180.0 μm - Charge: 53.85 pC - Rise Time: 0.94 ns

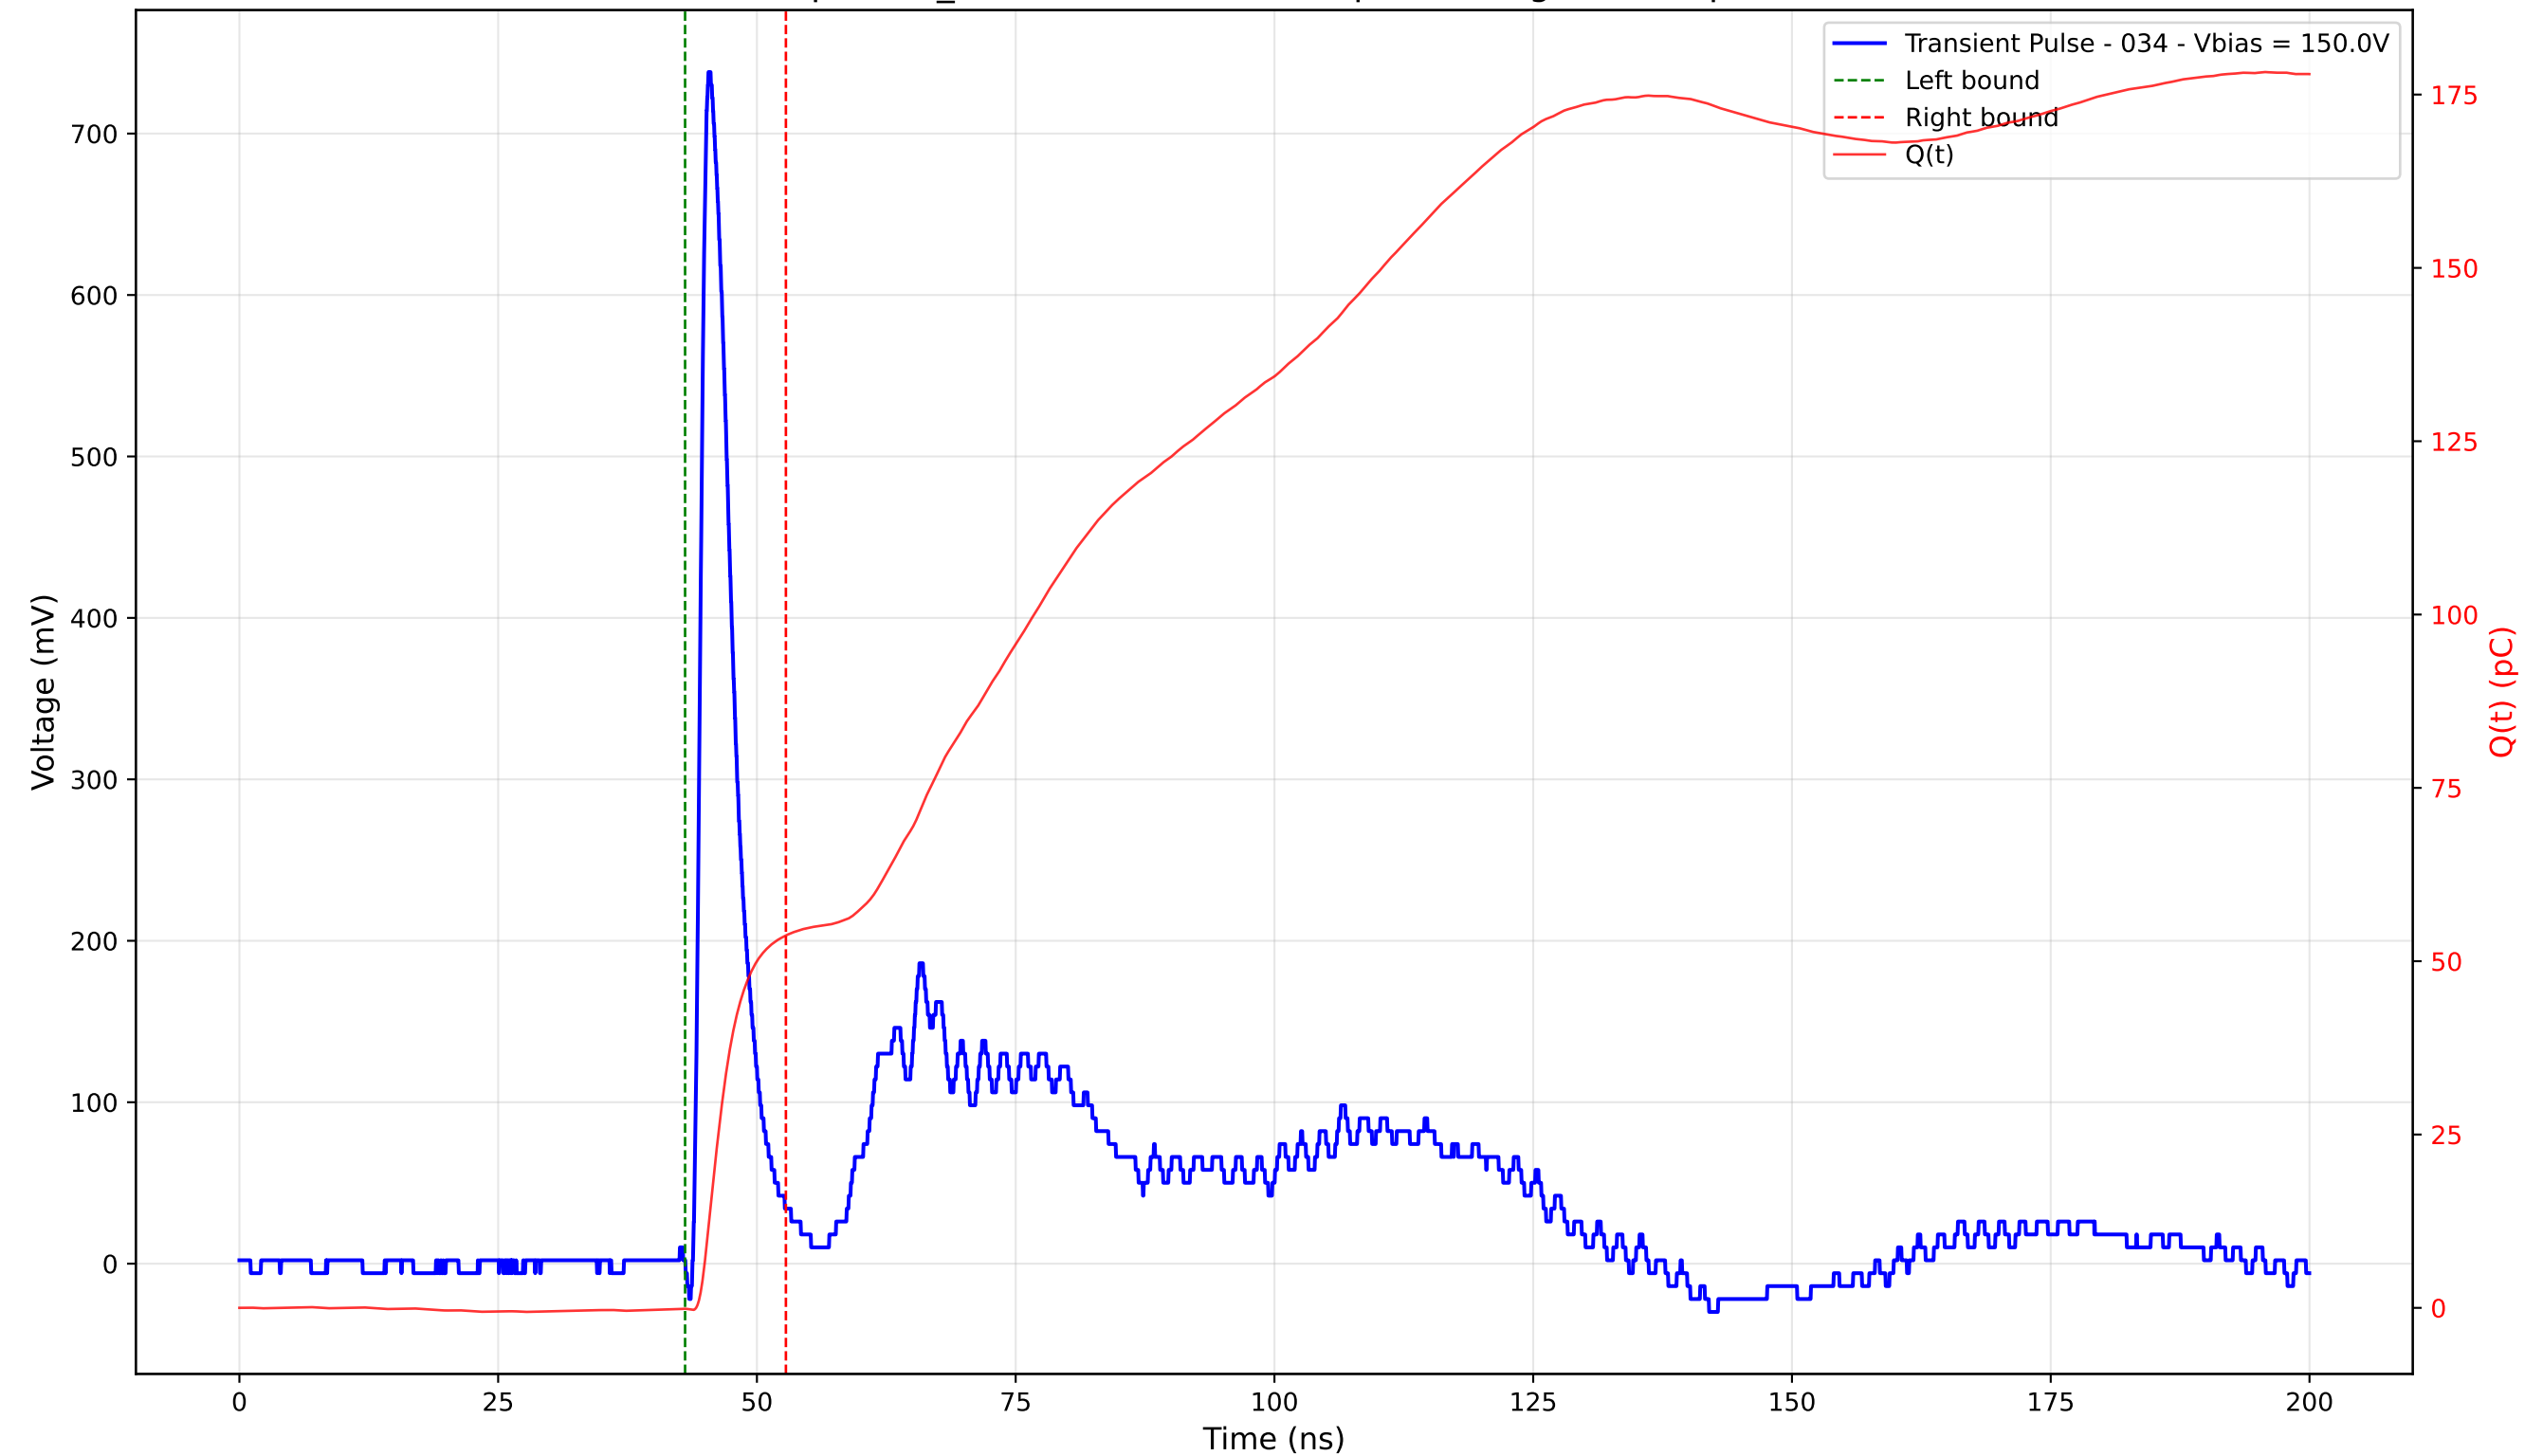


Transient Pulse - Sample: TD_4004 - Position: 185.0 μm - Charge: 55.16 pC - Rise Time: 0.94 ns

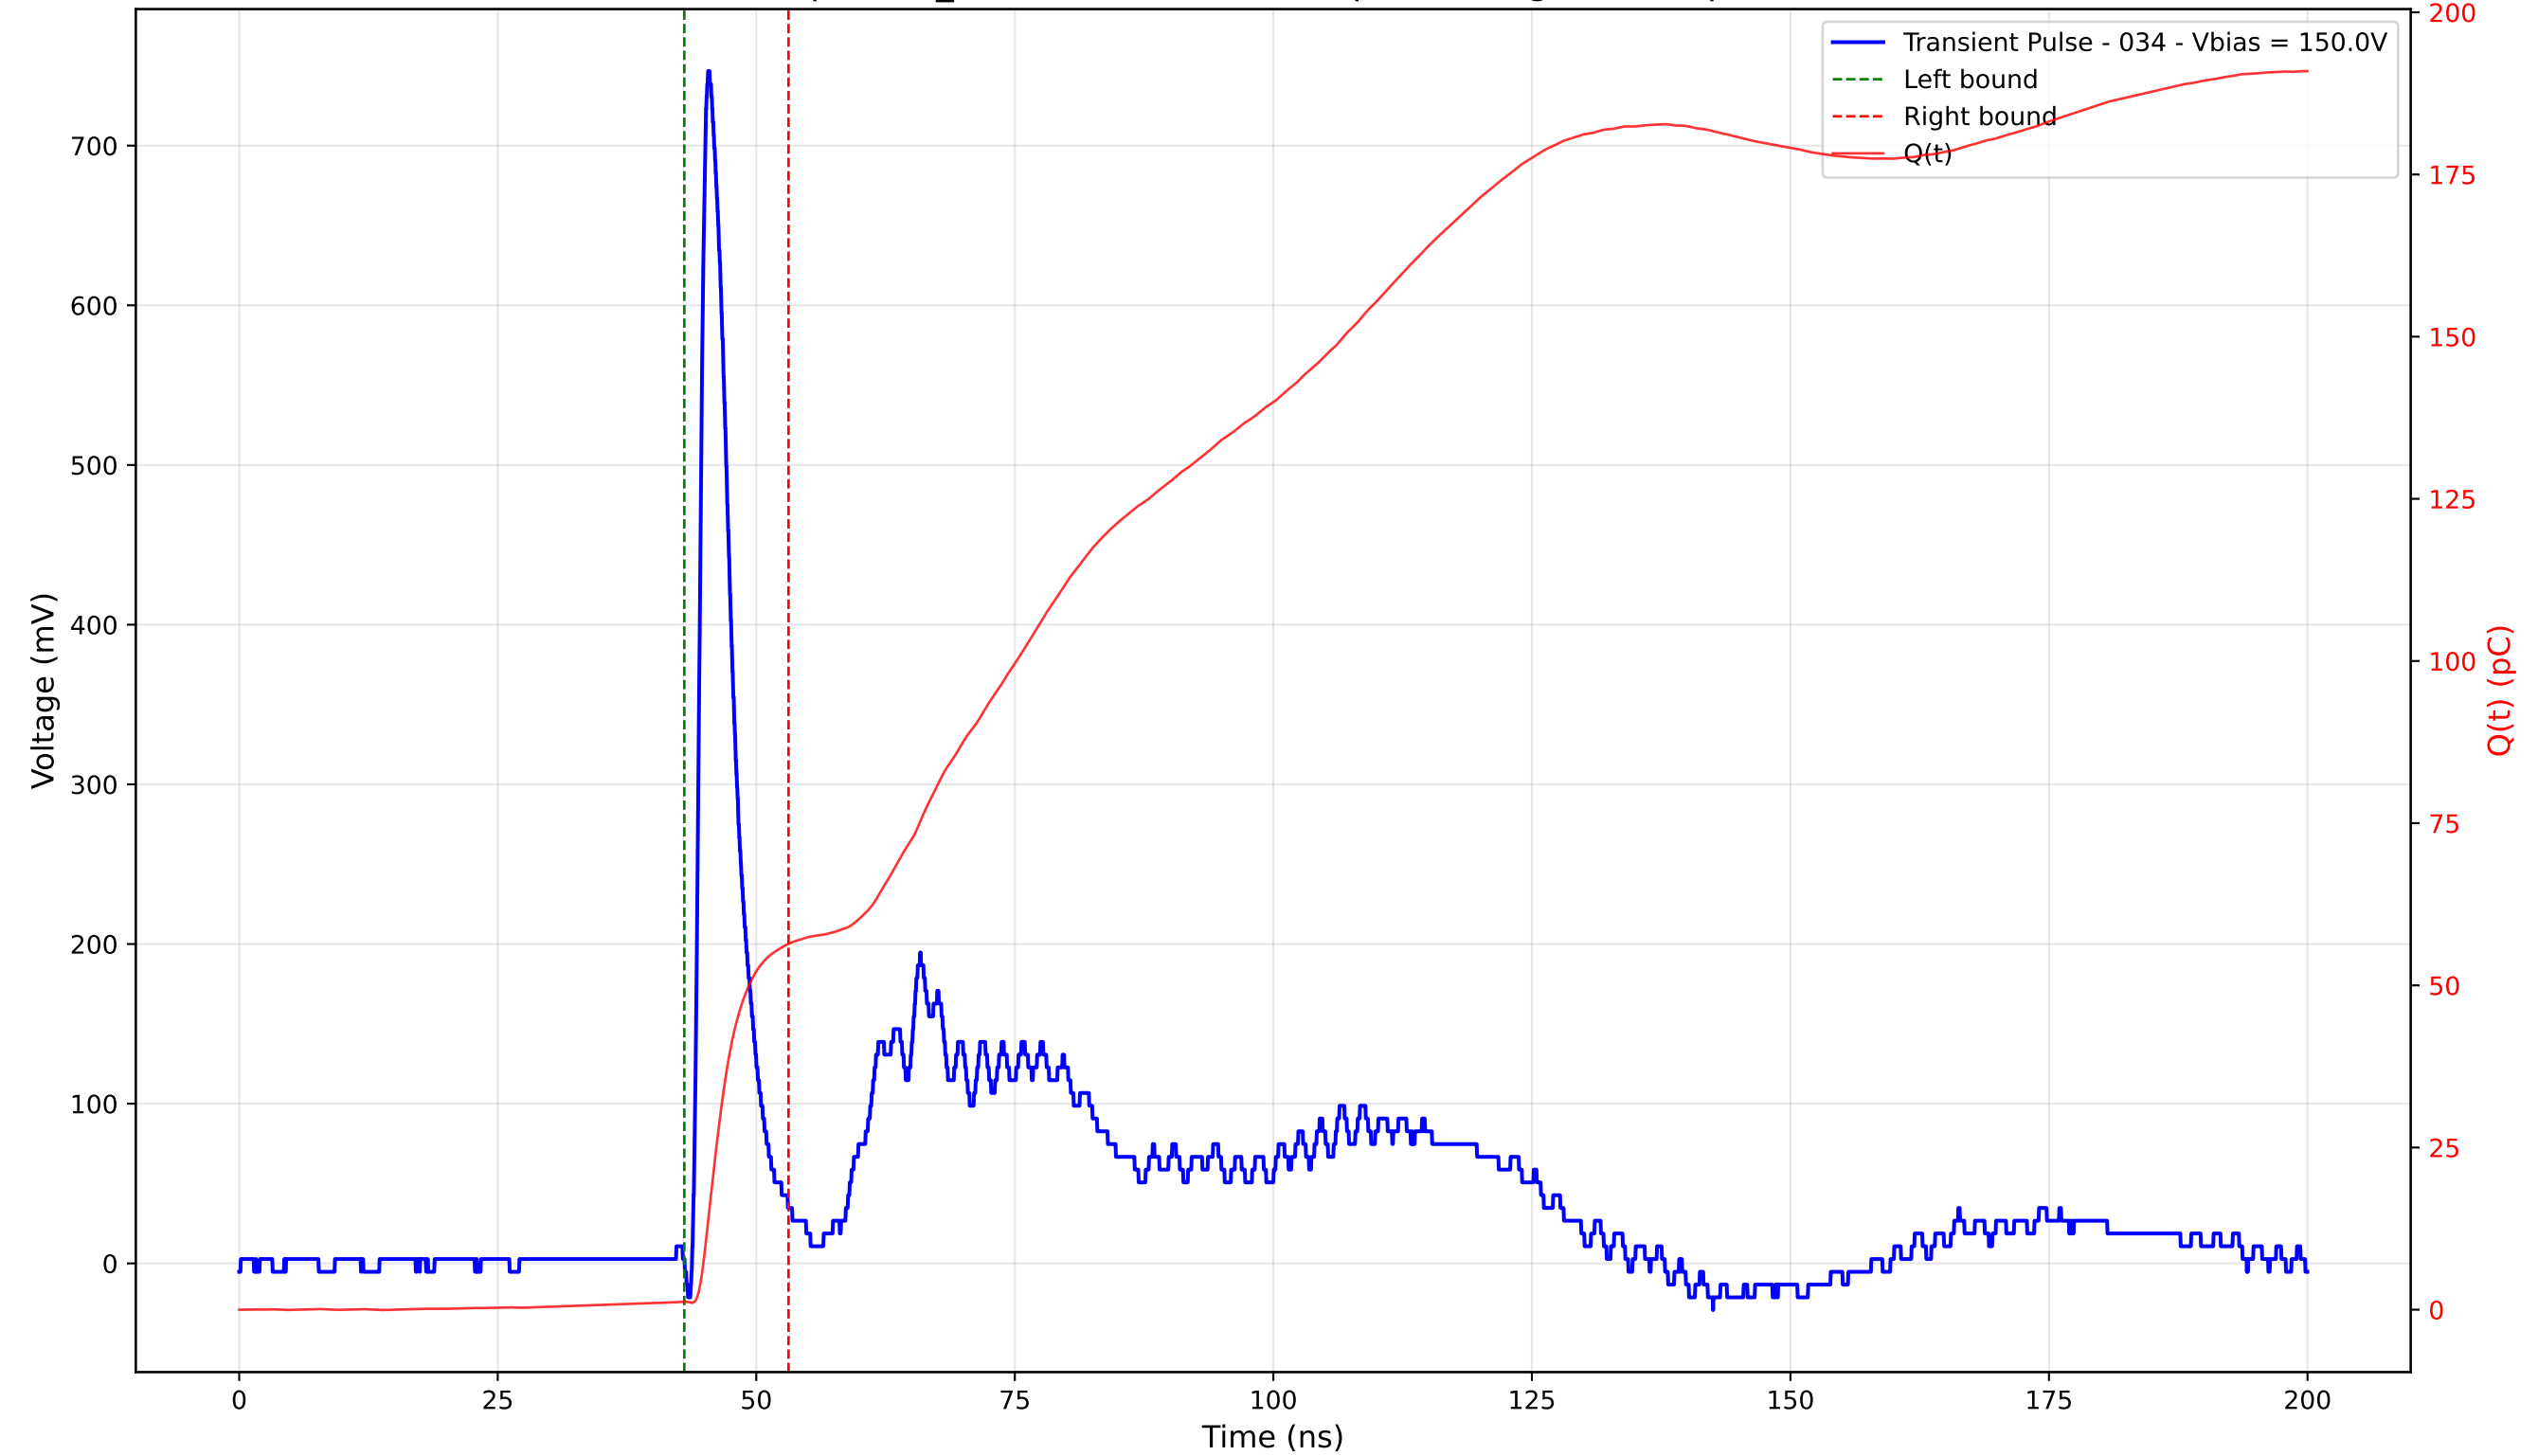


Transient Pulse - Sample: TD_4004 - Position: 190.0 μm - Charge: 54.55 pC - Rise Time: 0.94 ns

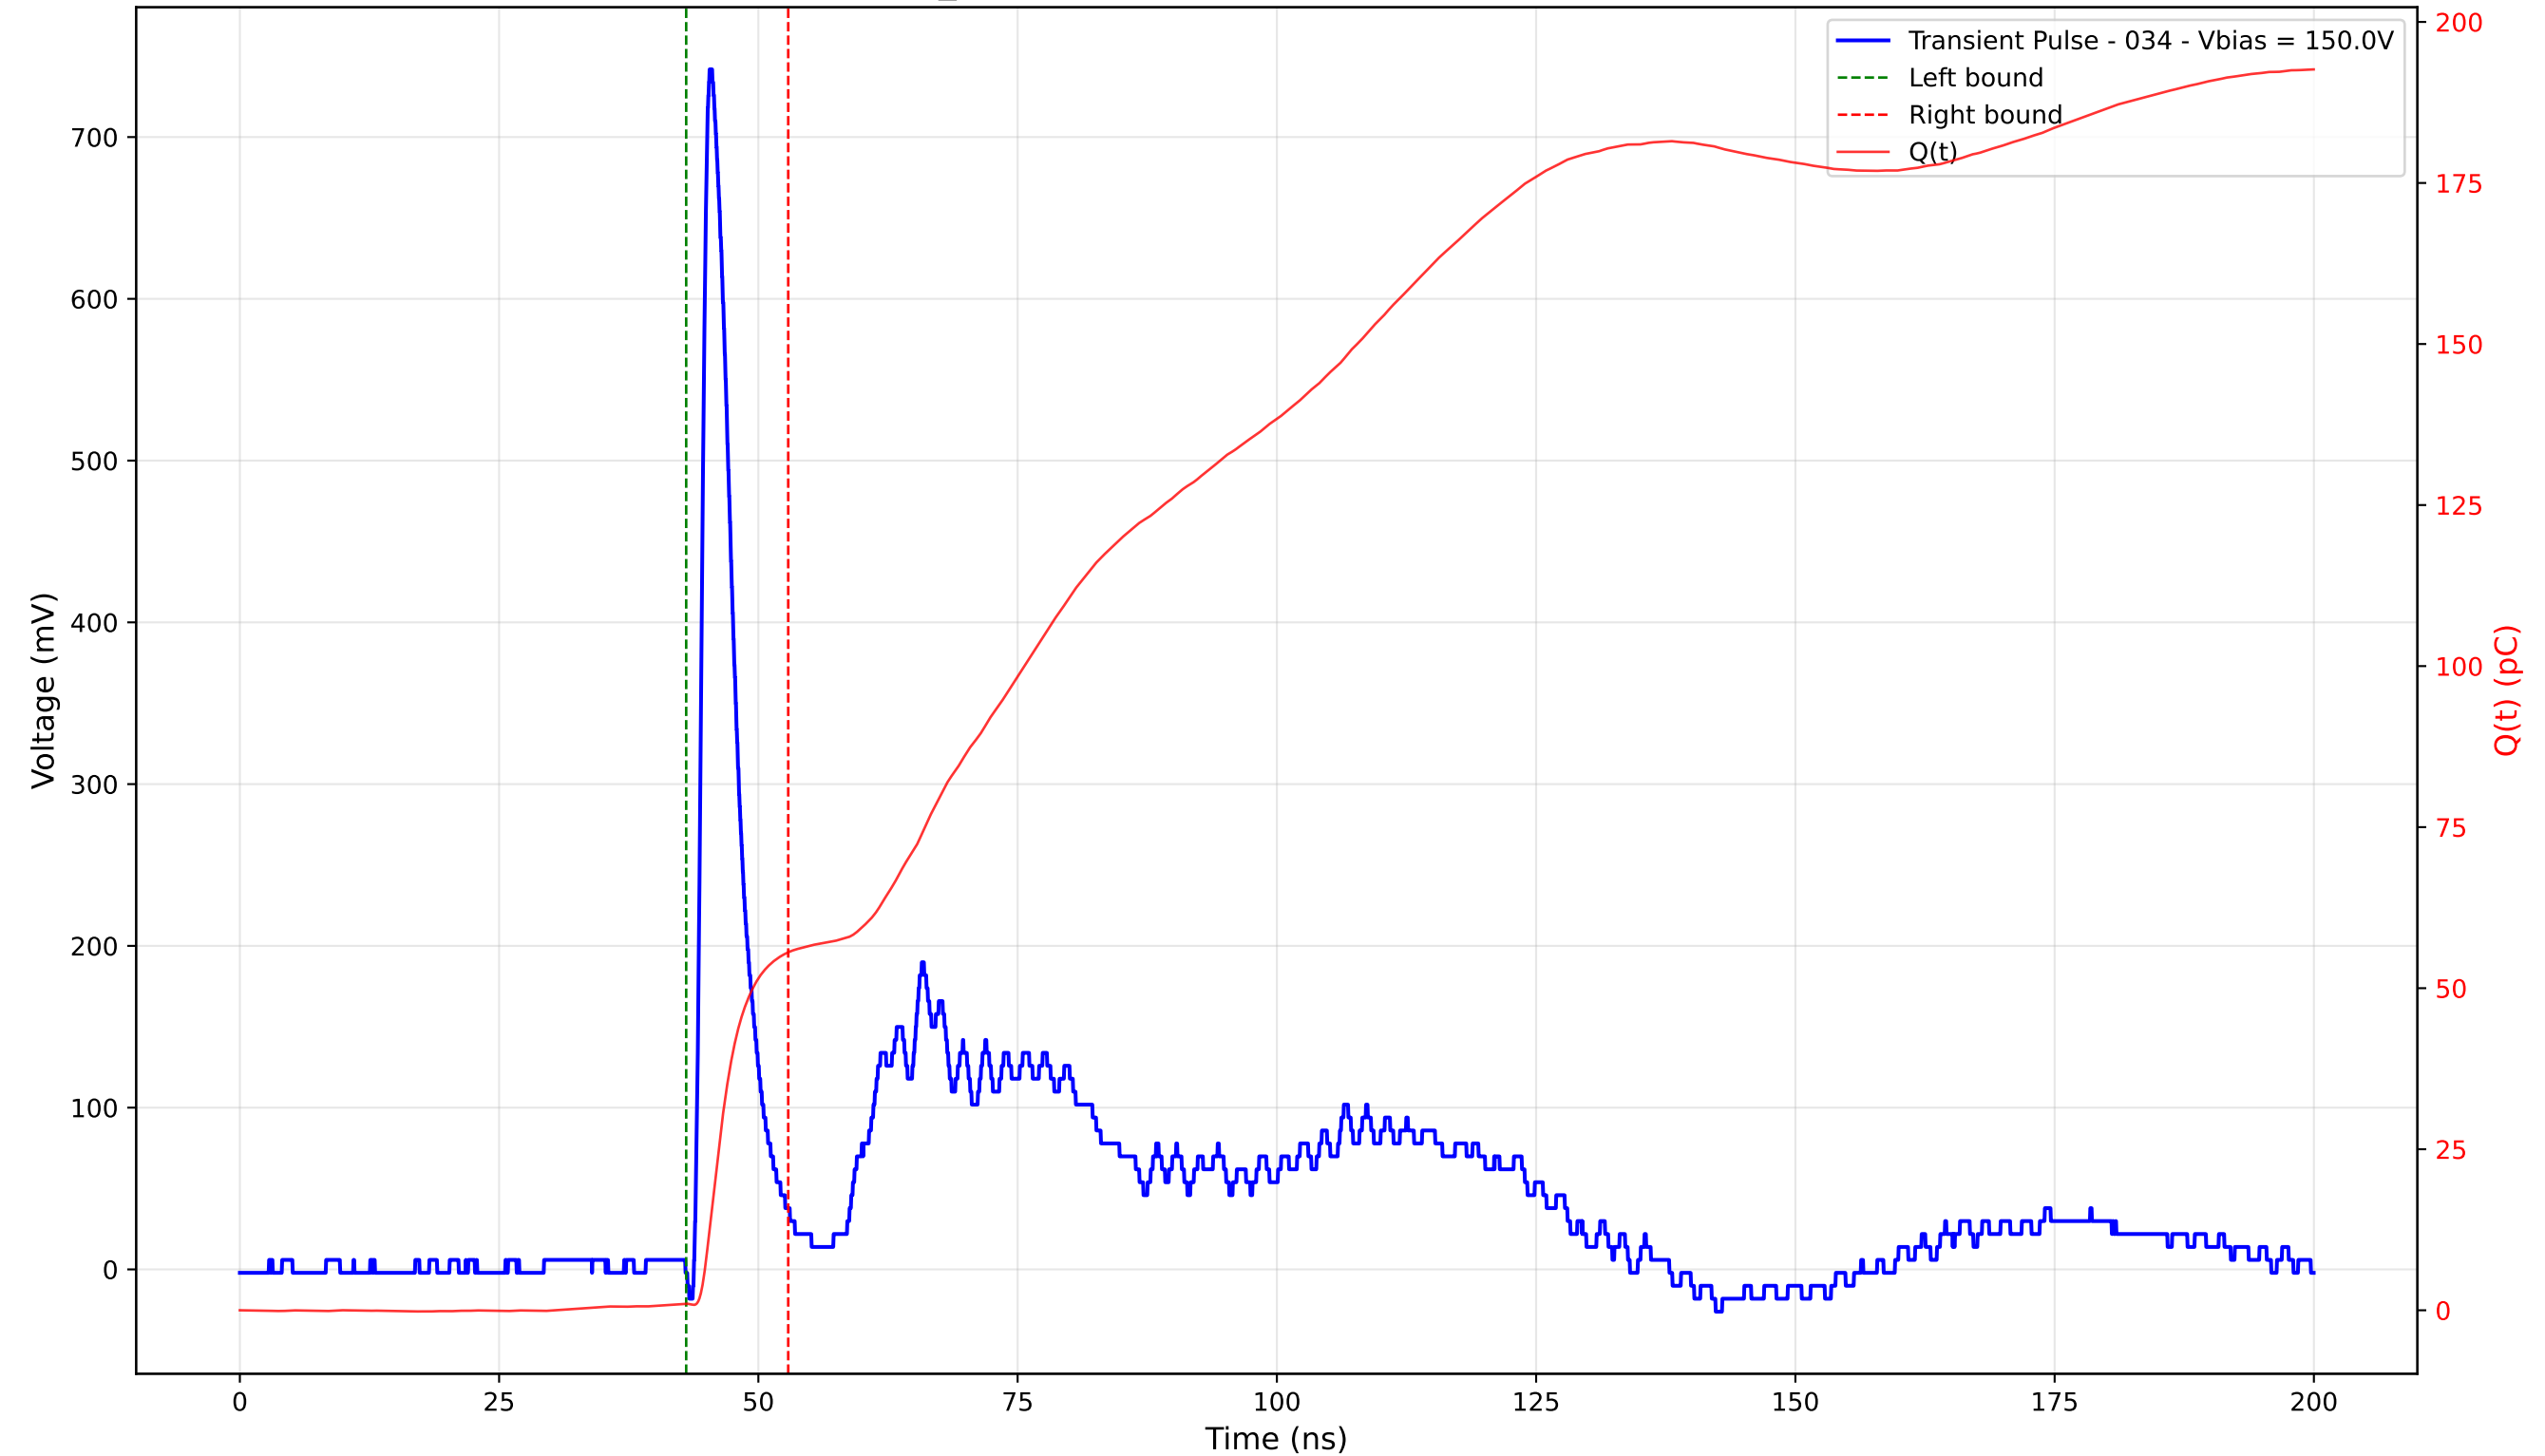


Transient Pulse - Sample: TD_4004 - Position: 195.0 μm - Charge: 54.18 pC - Rise Time: 0.94 ns

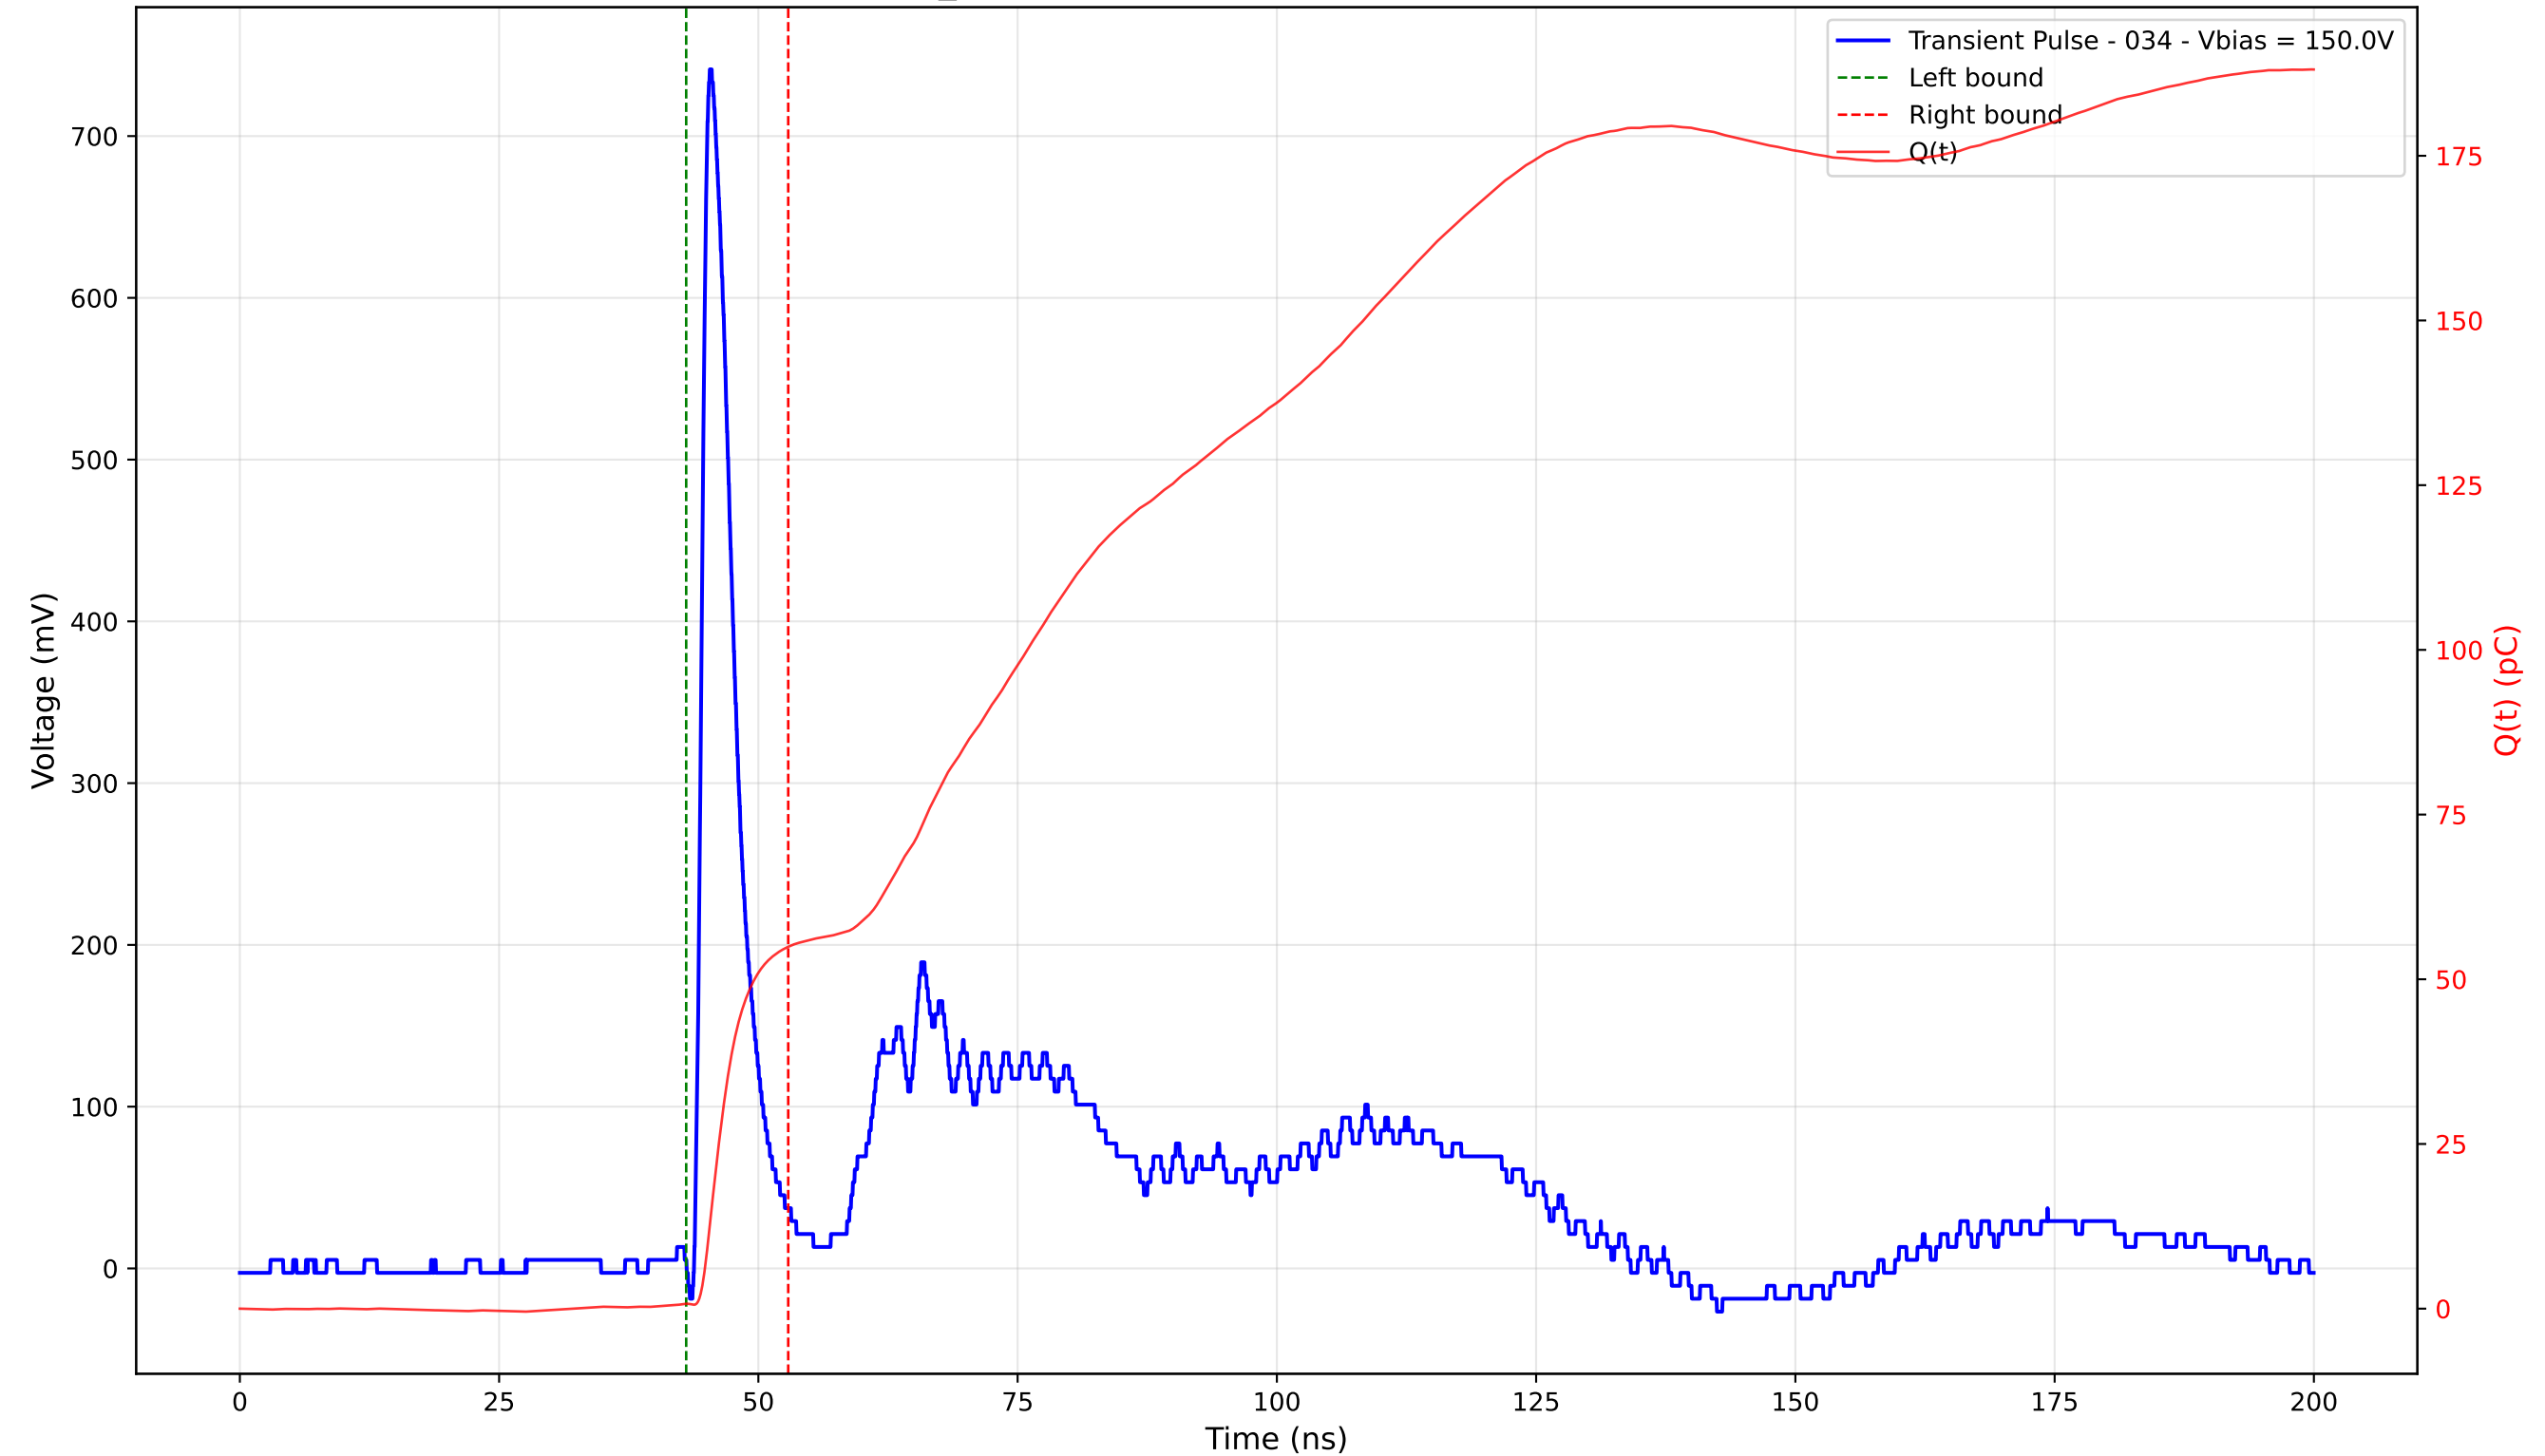


Transient Pulse - Sample: TD_4004 - Position: 200.0 μm - Charge: 53.37 pC - Rise Time: 0.95 ns

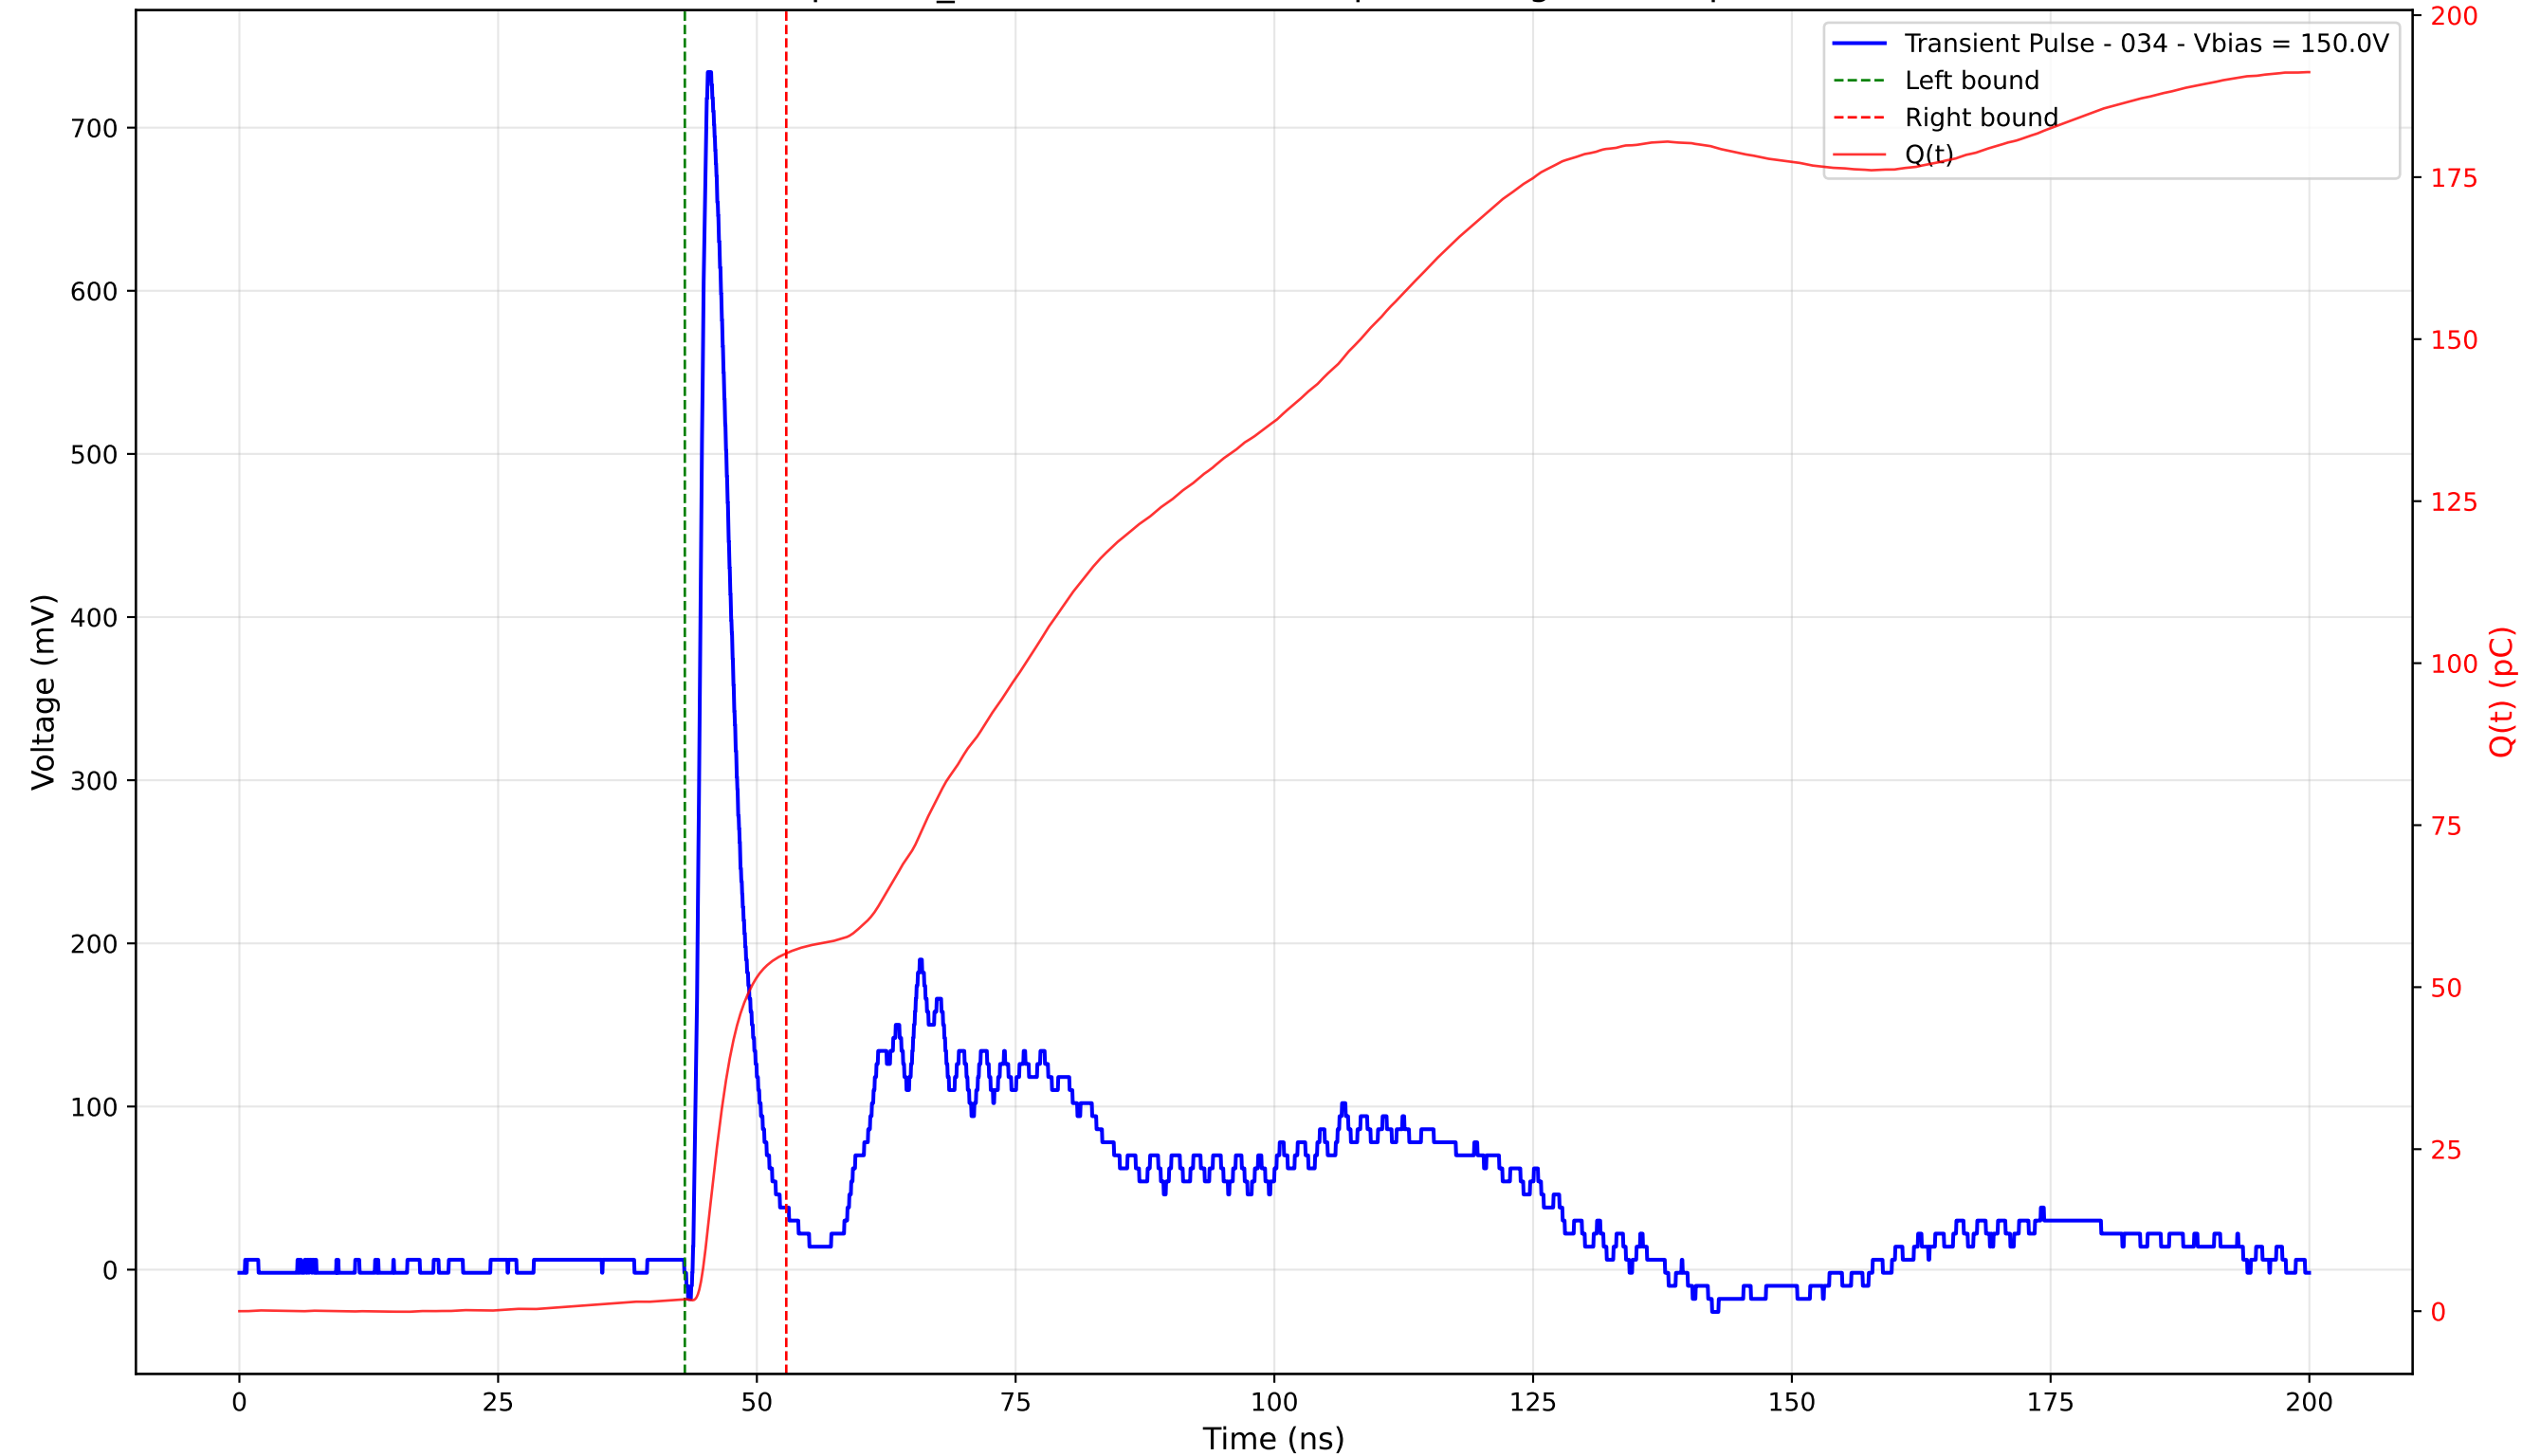


Transient Pulse - Sample: TD_4004 - Position: 205.0 μm - Charge: 51.31 pC - Rise Time: 0.96 ns

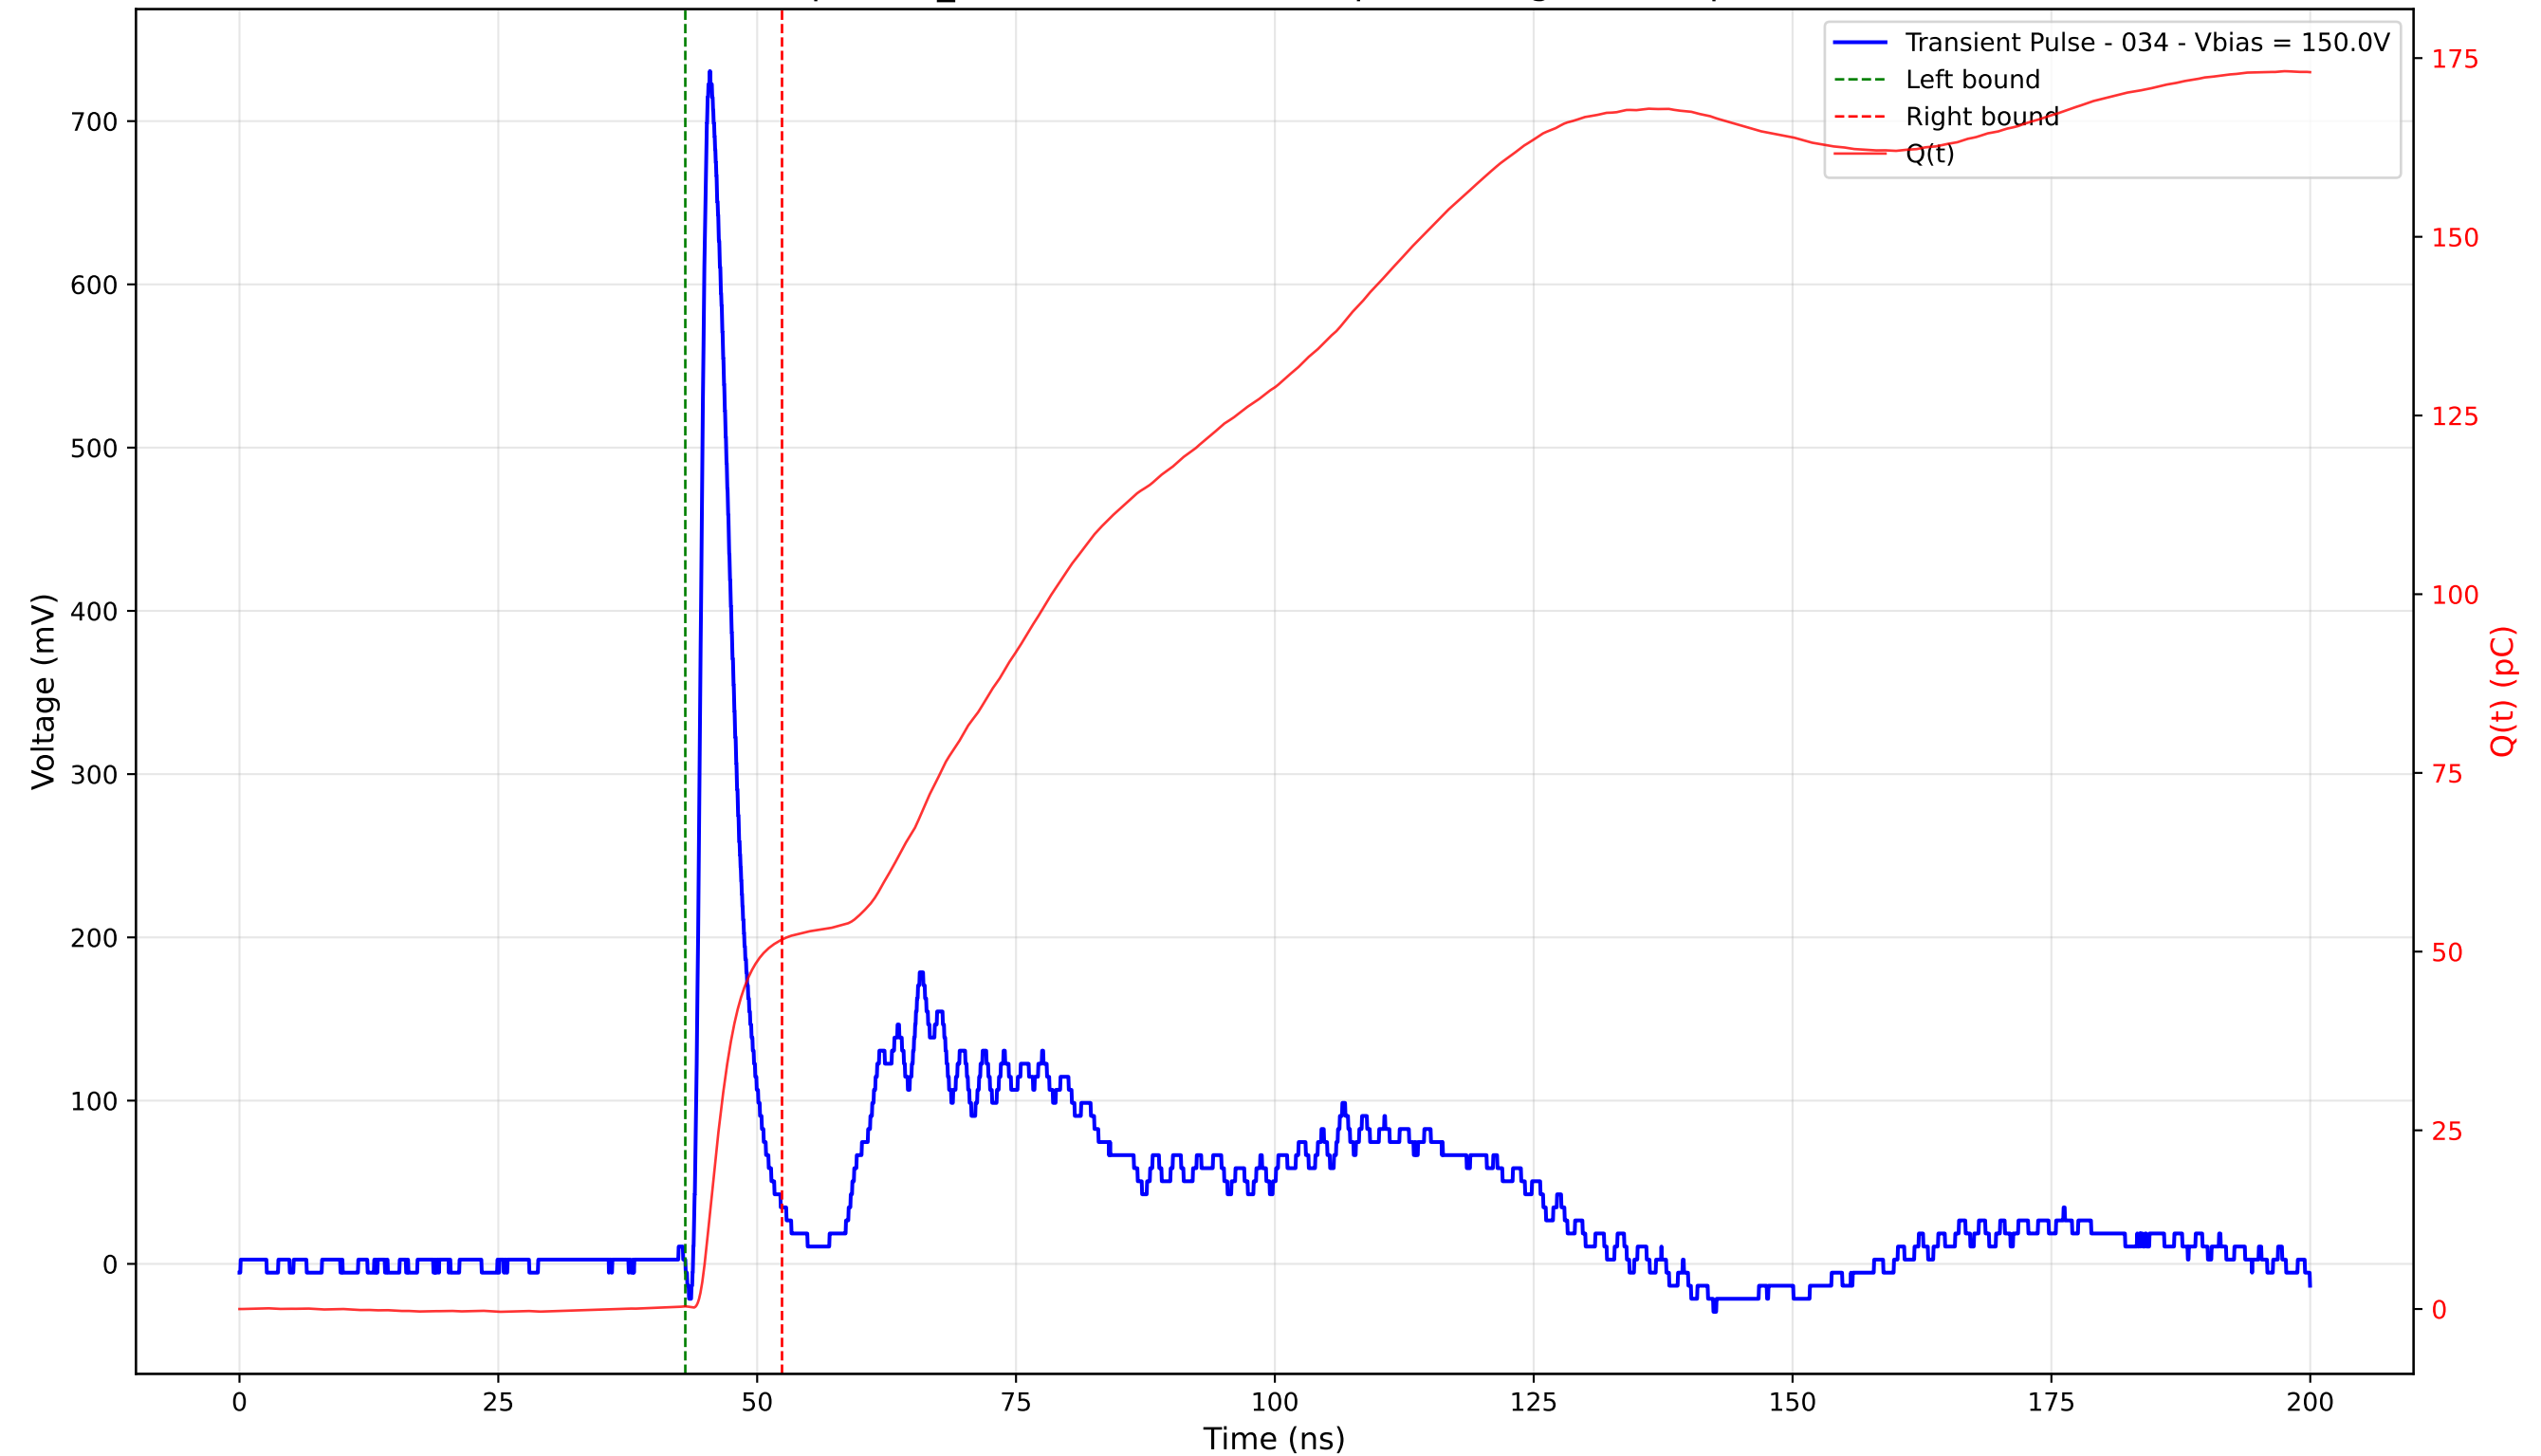


Transient Pulse - Sample: TD_4004 - Position: 210.0 μm - Charge: 49.95 pC - Rise Time: 0.97 ns

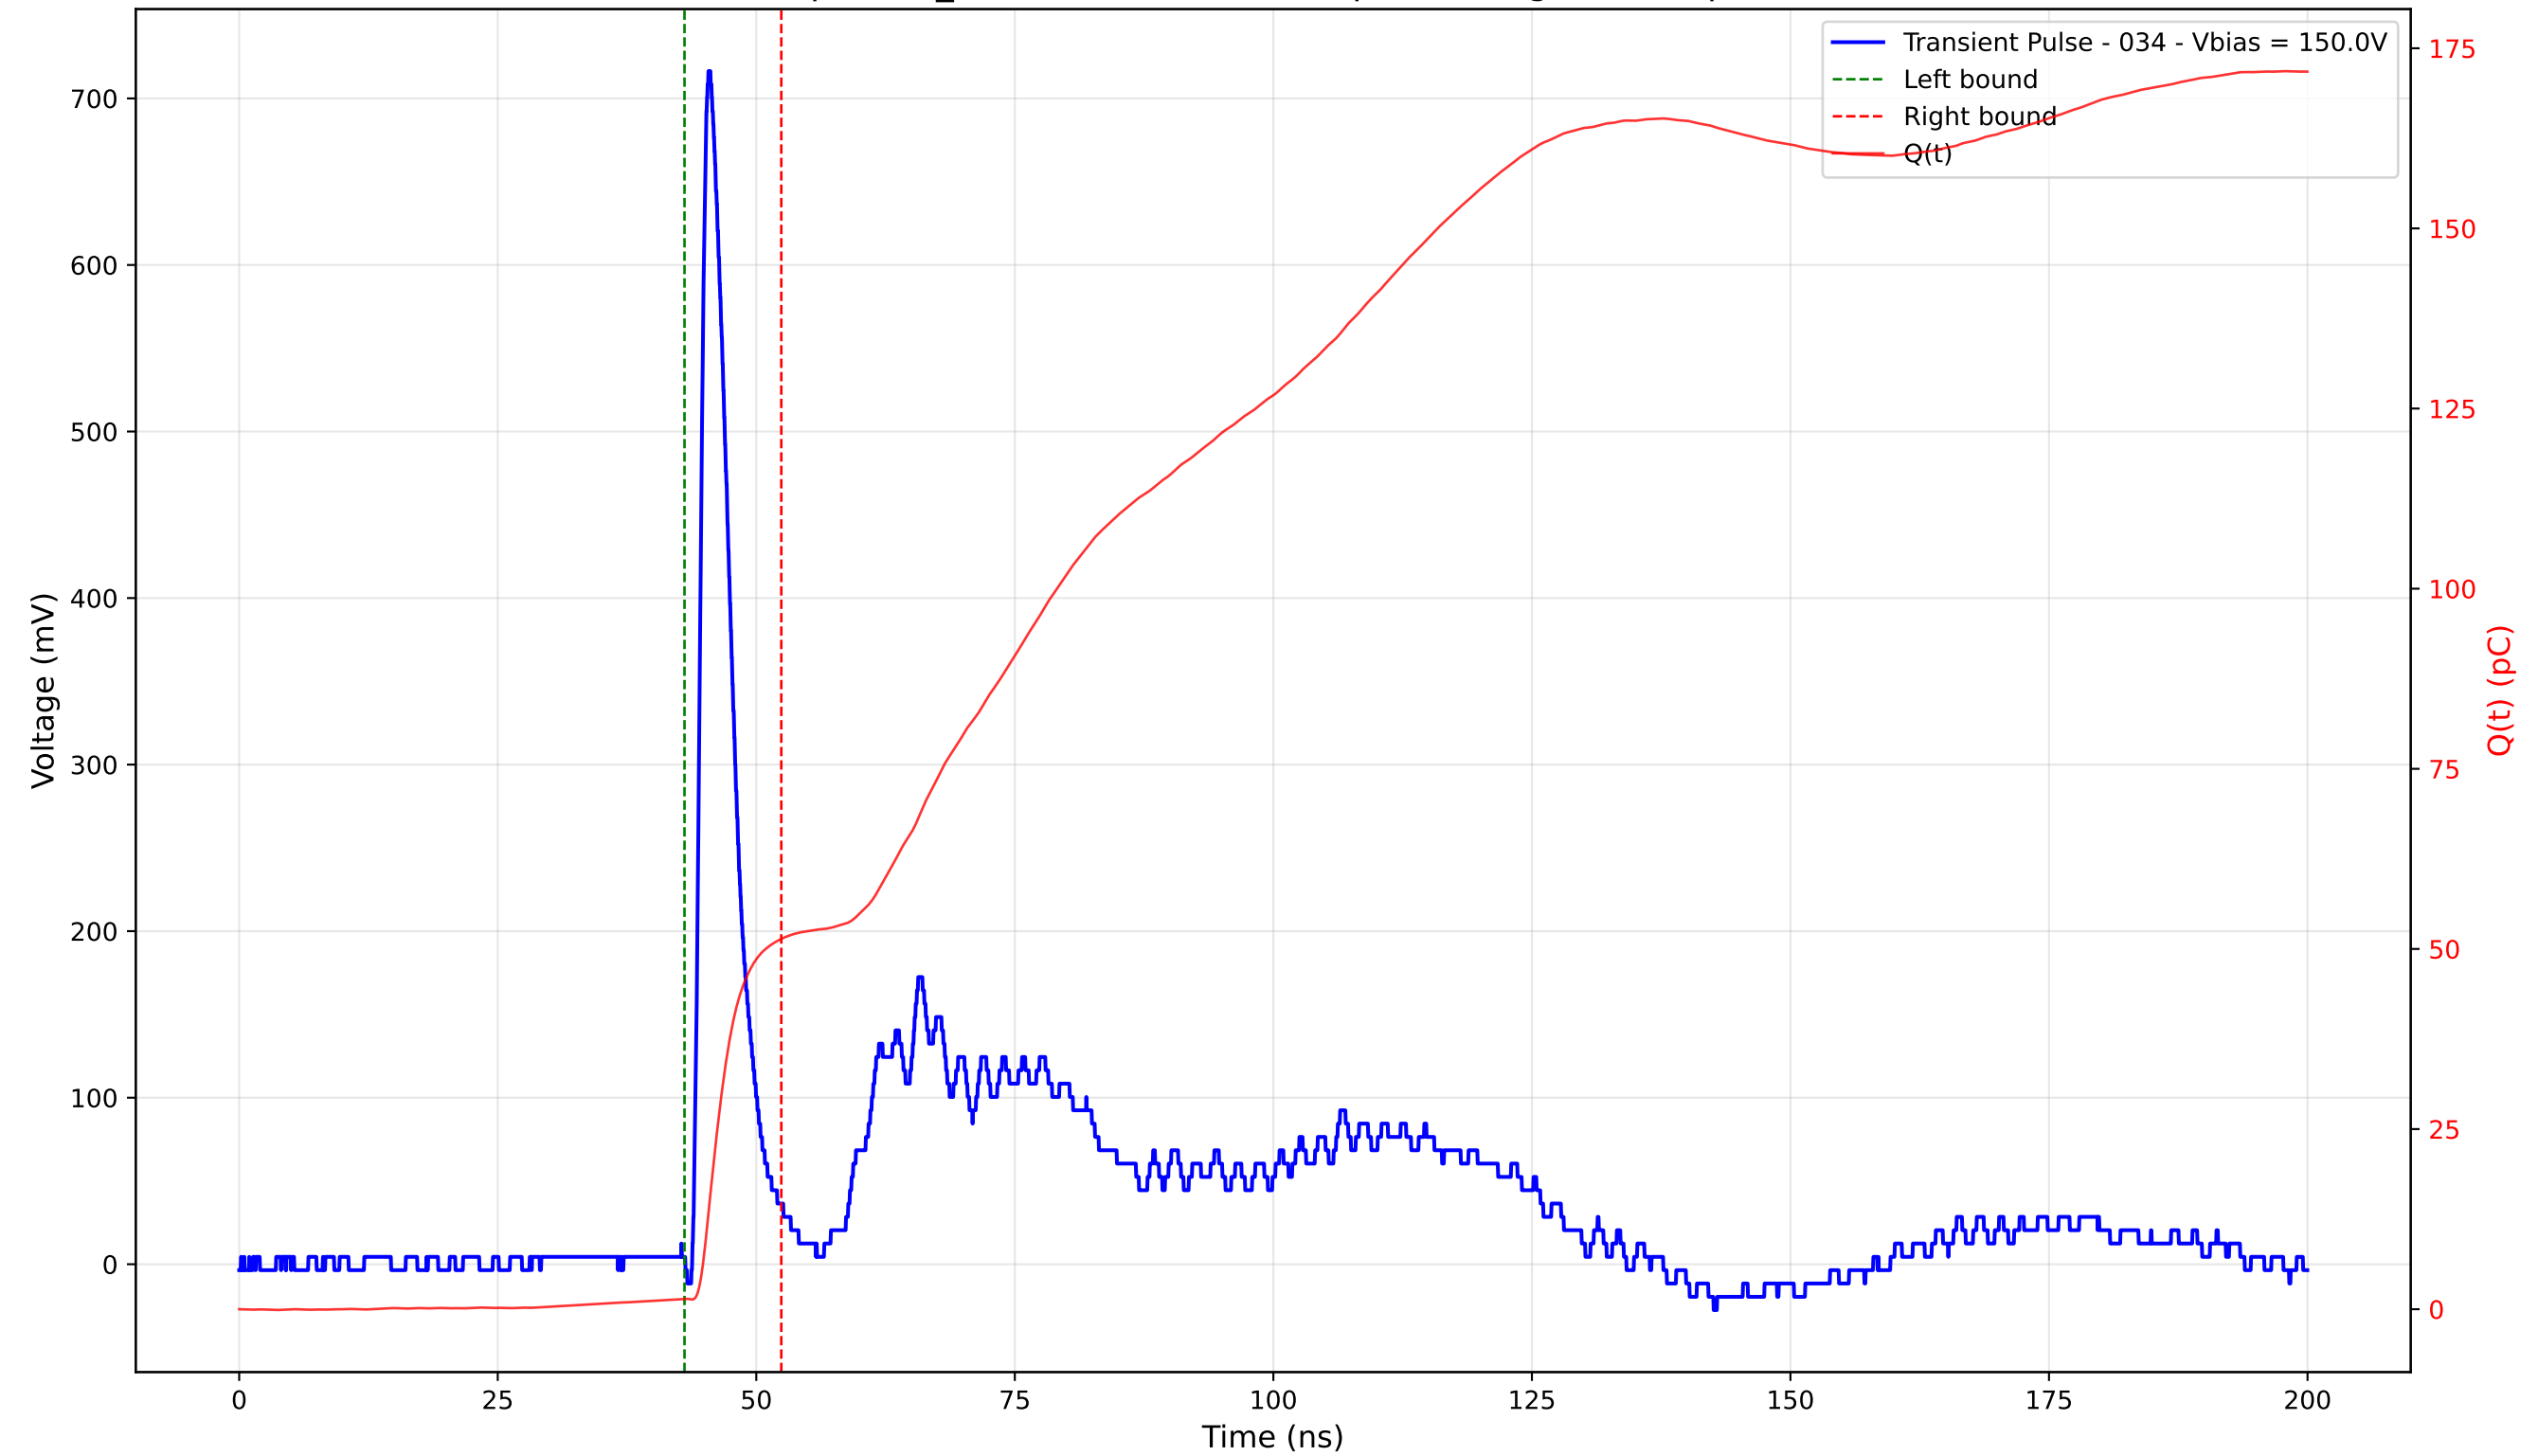


Transient Pulse - Sample: TD_4004 - Position: 215.0 μm - Charge: 49.64 pC - Rise Time: 1.00 ns

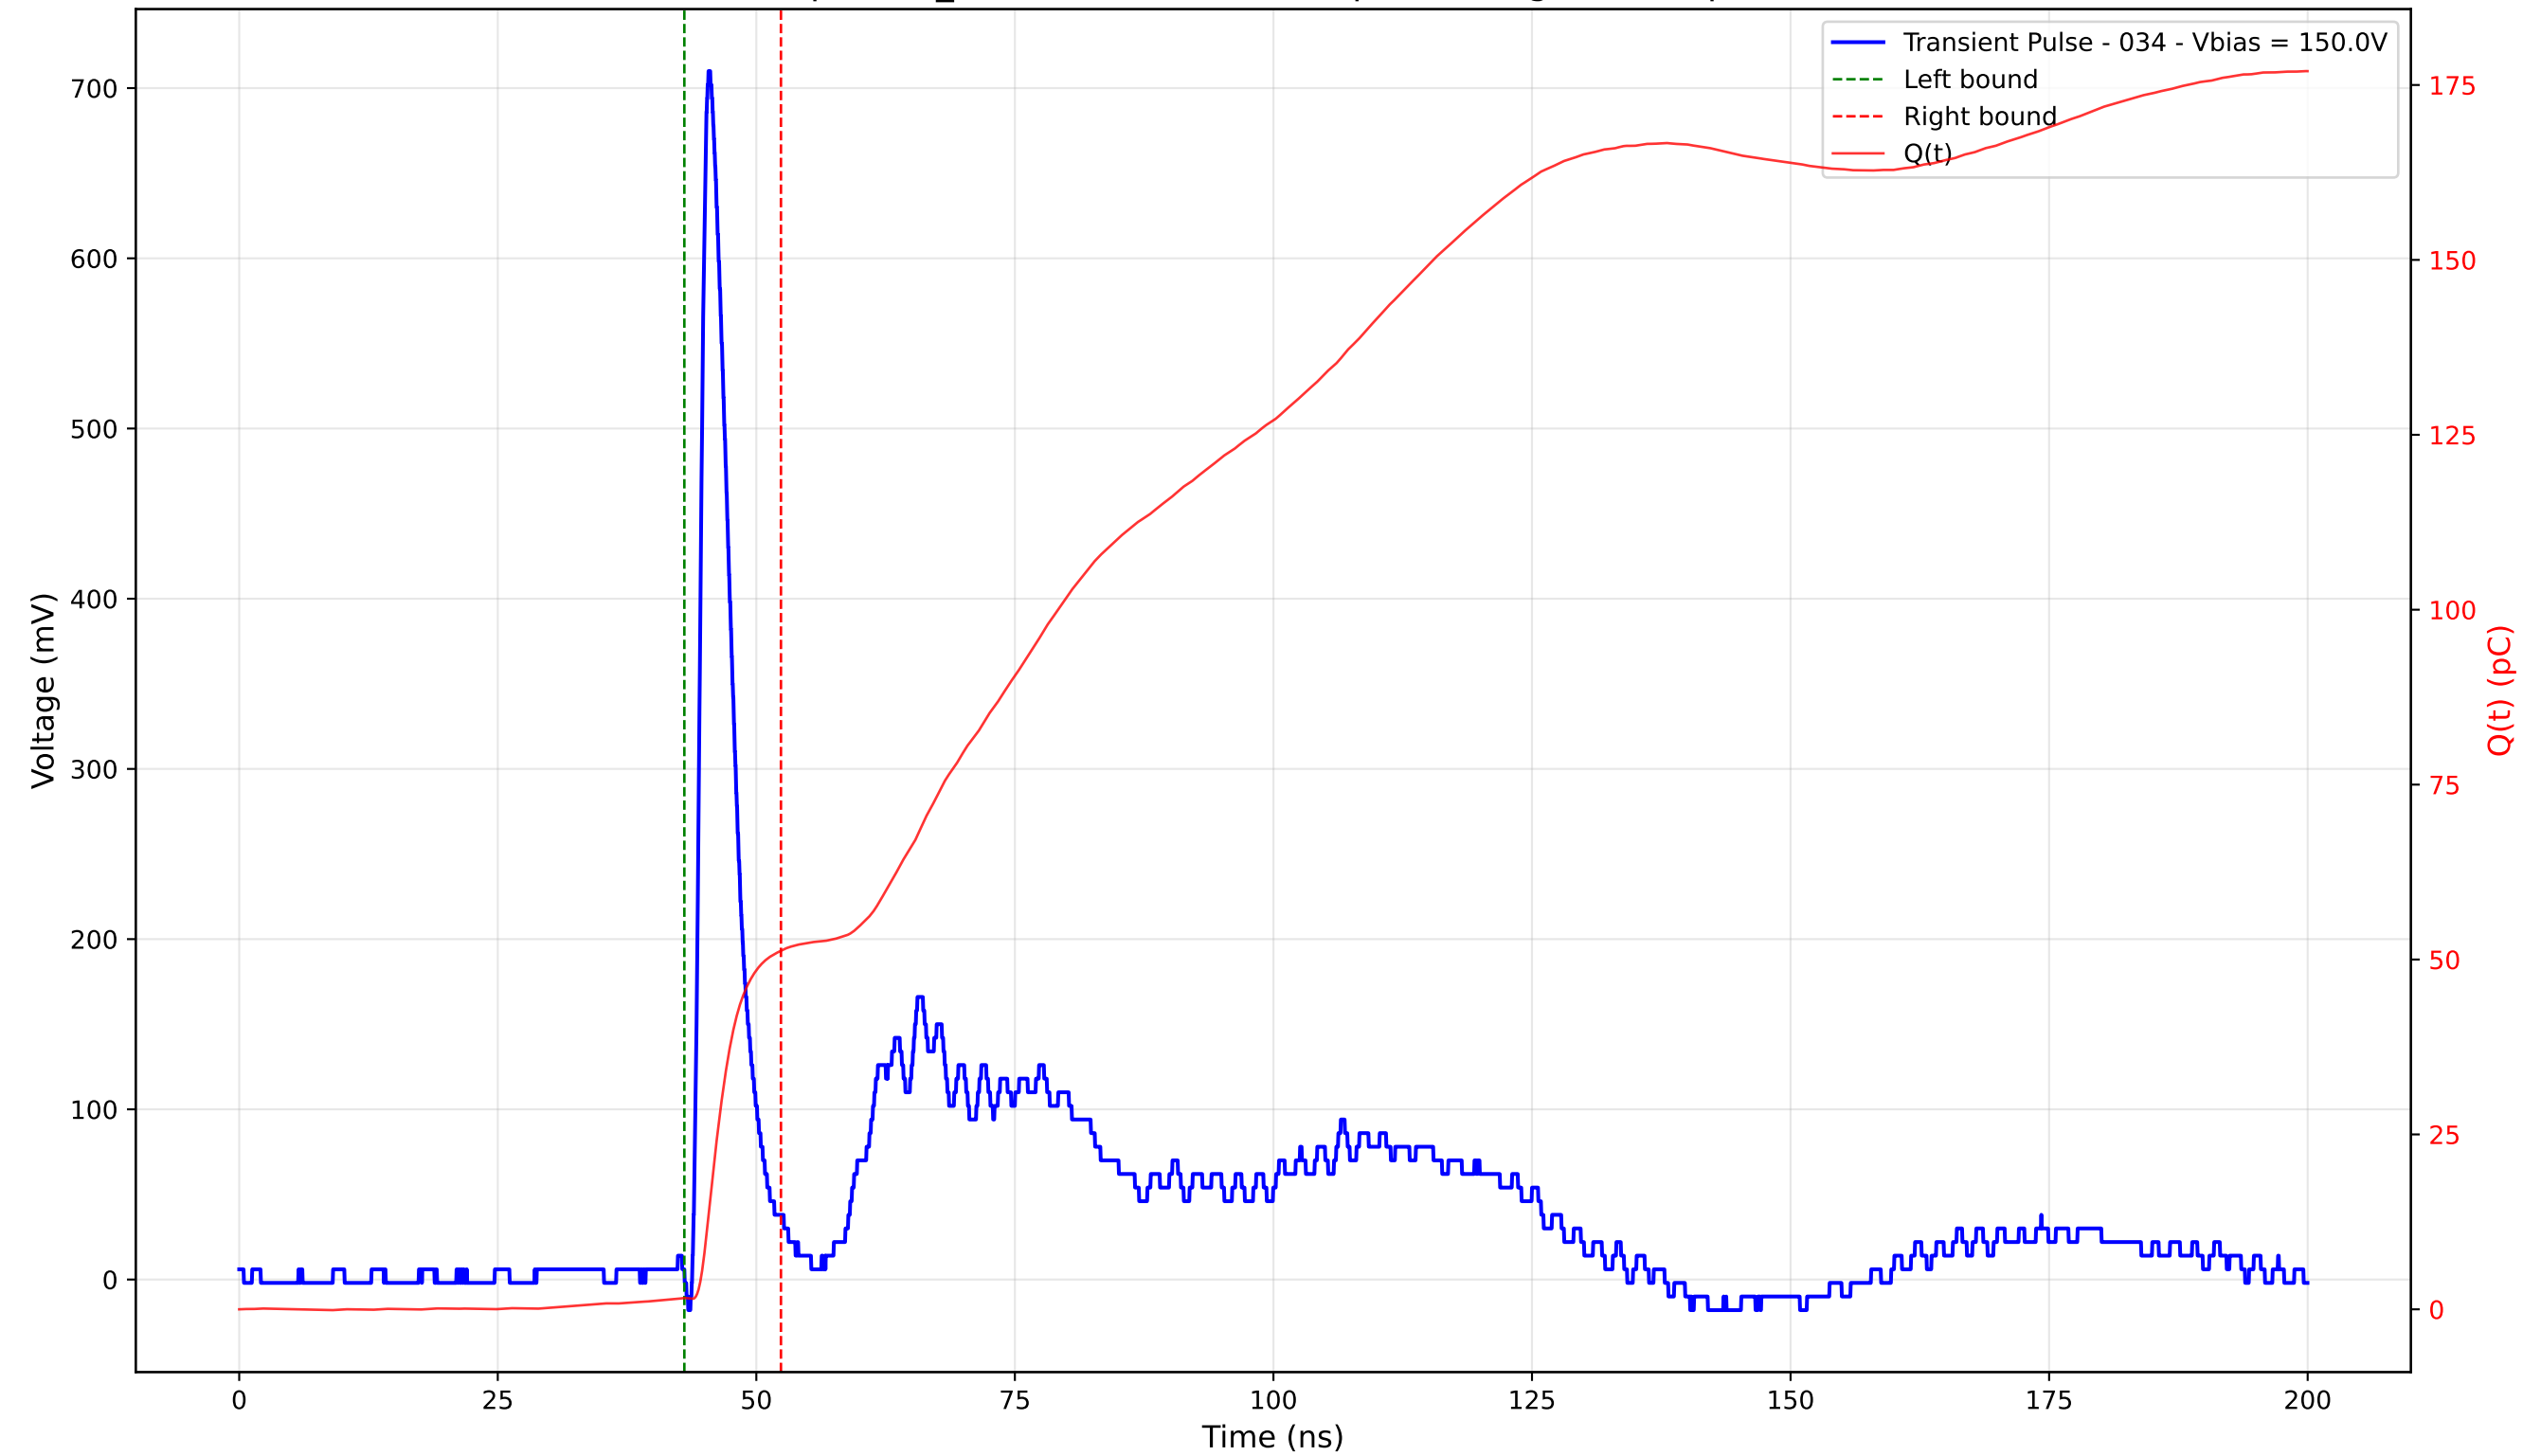


Transient Pulse - Sample: TD_4004 - Position: 220.0 μm - Charge: 49.44 pC - Rise Time: 0.99 ns

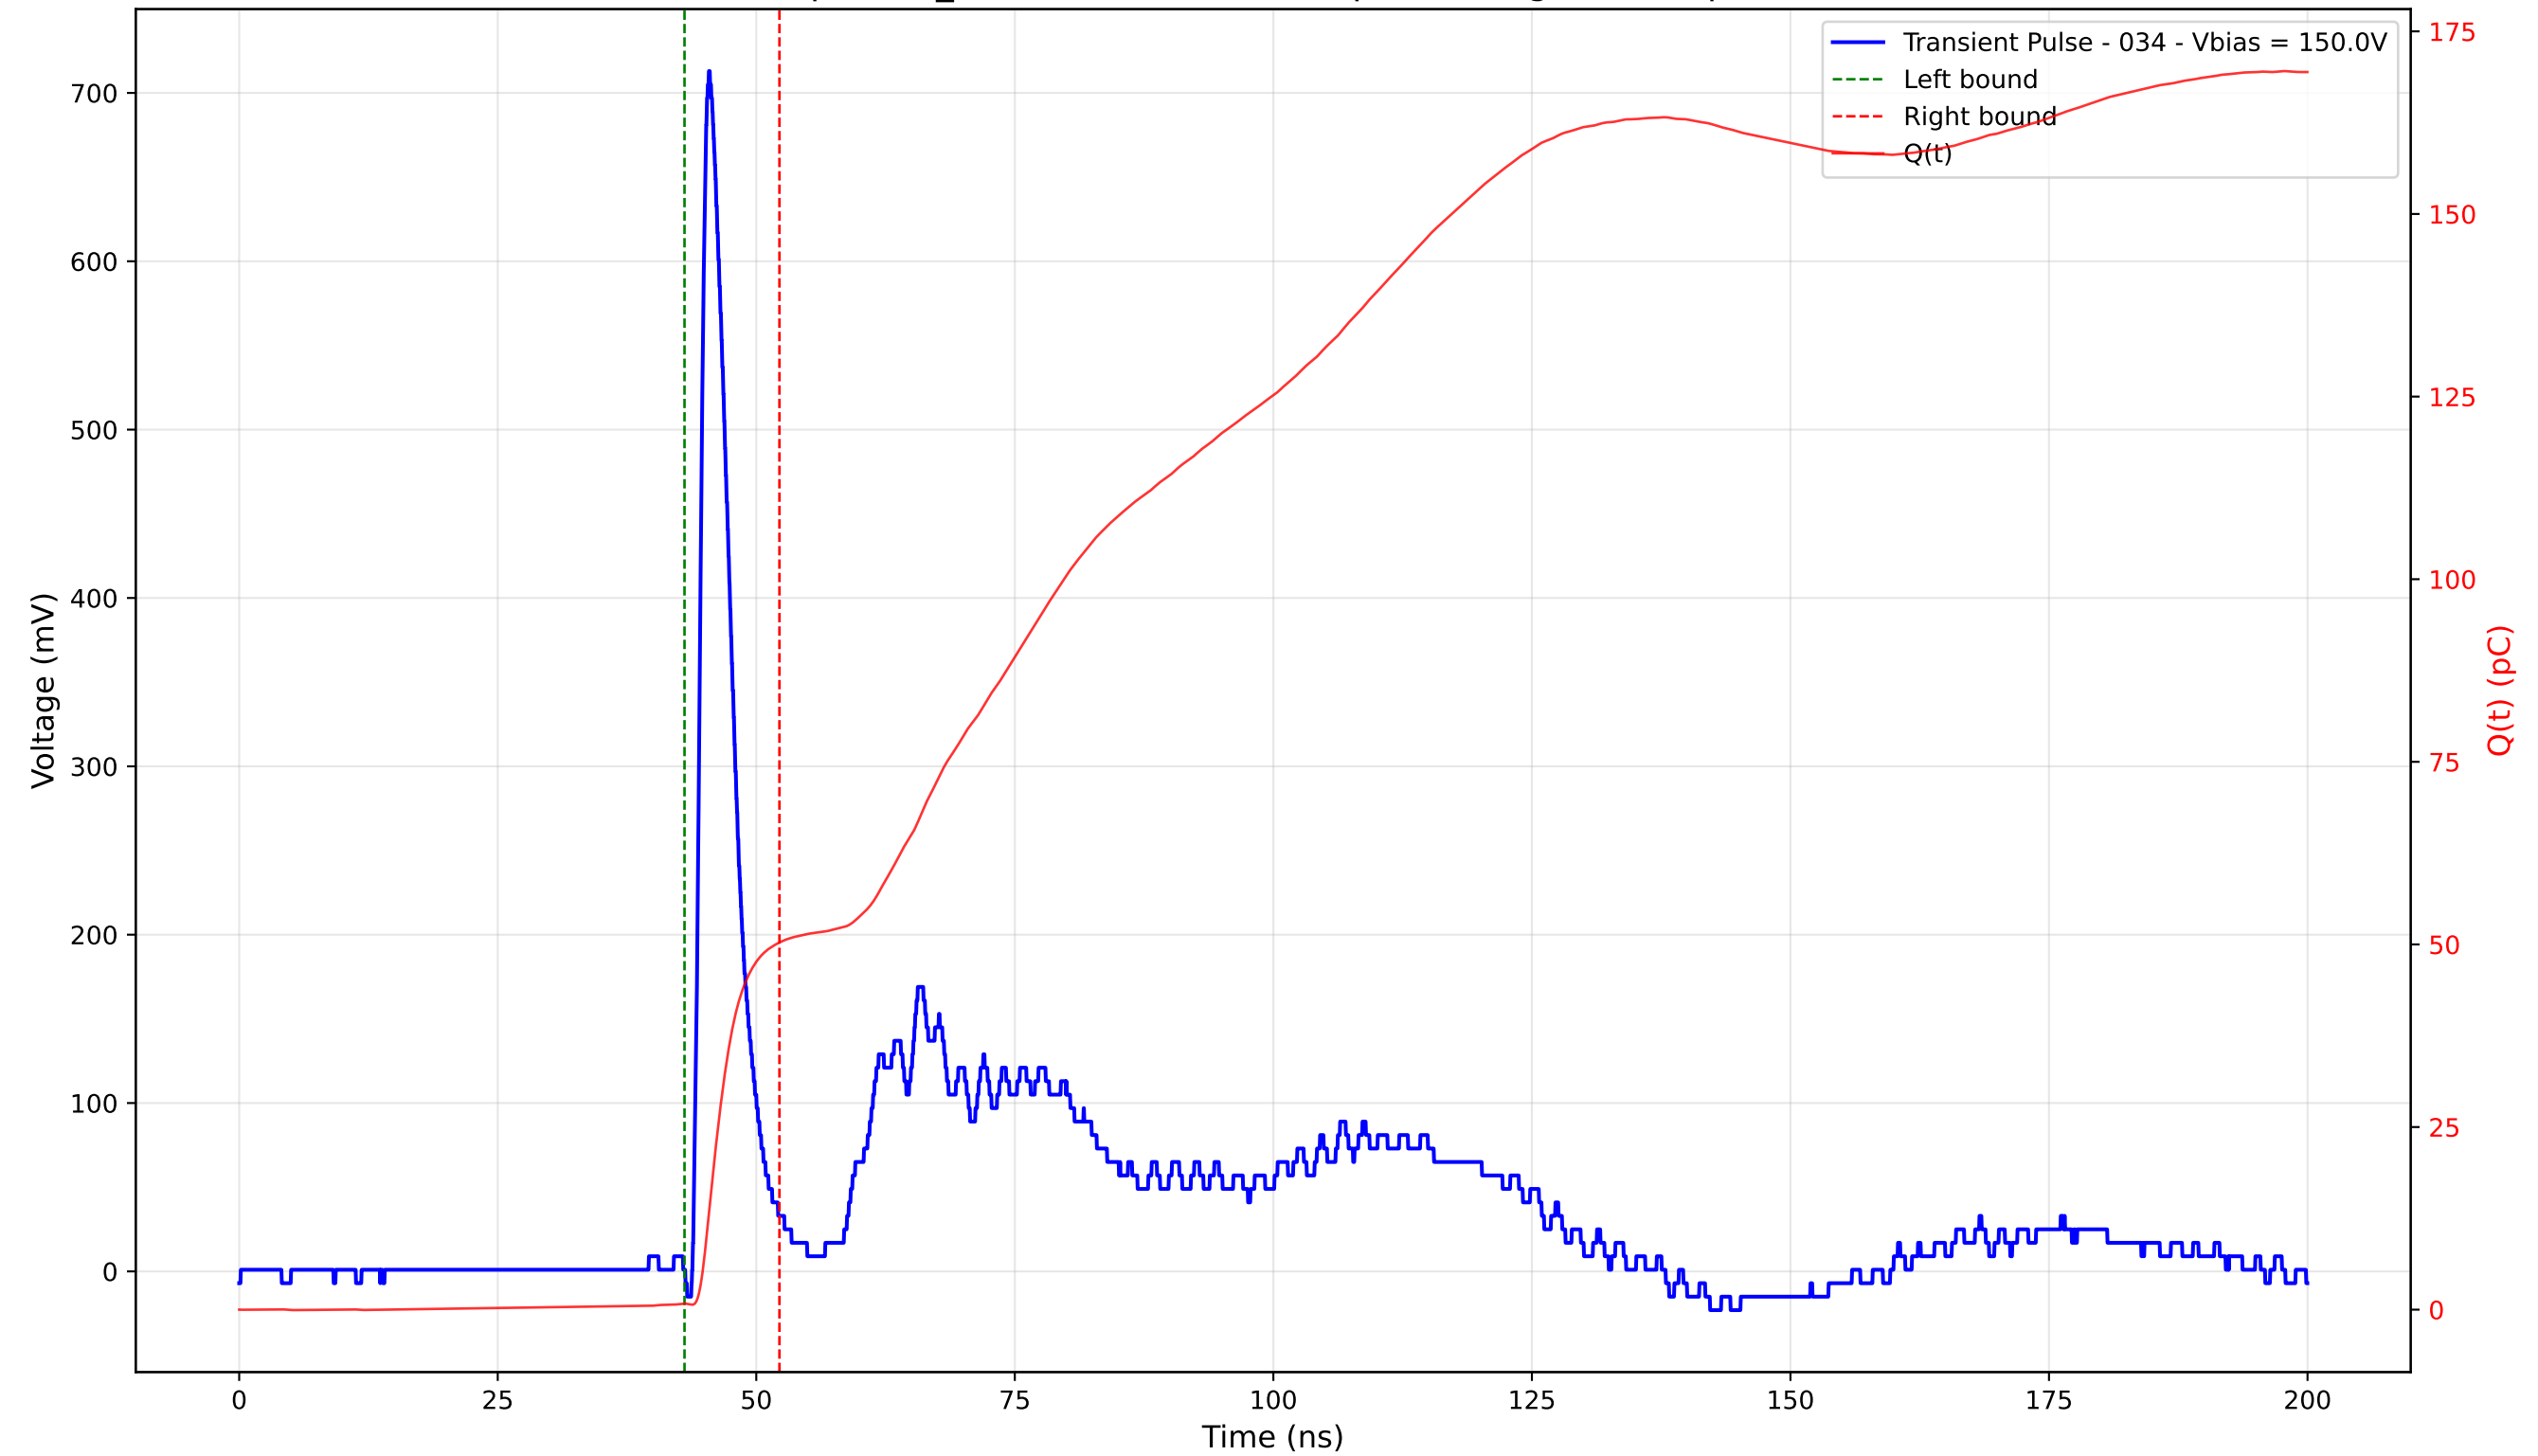


Transient Pulse - Sample: TD_4004 - Position: 225.0 μm - Charge: 48.06 pC - Rise Time: 0.98 ns

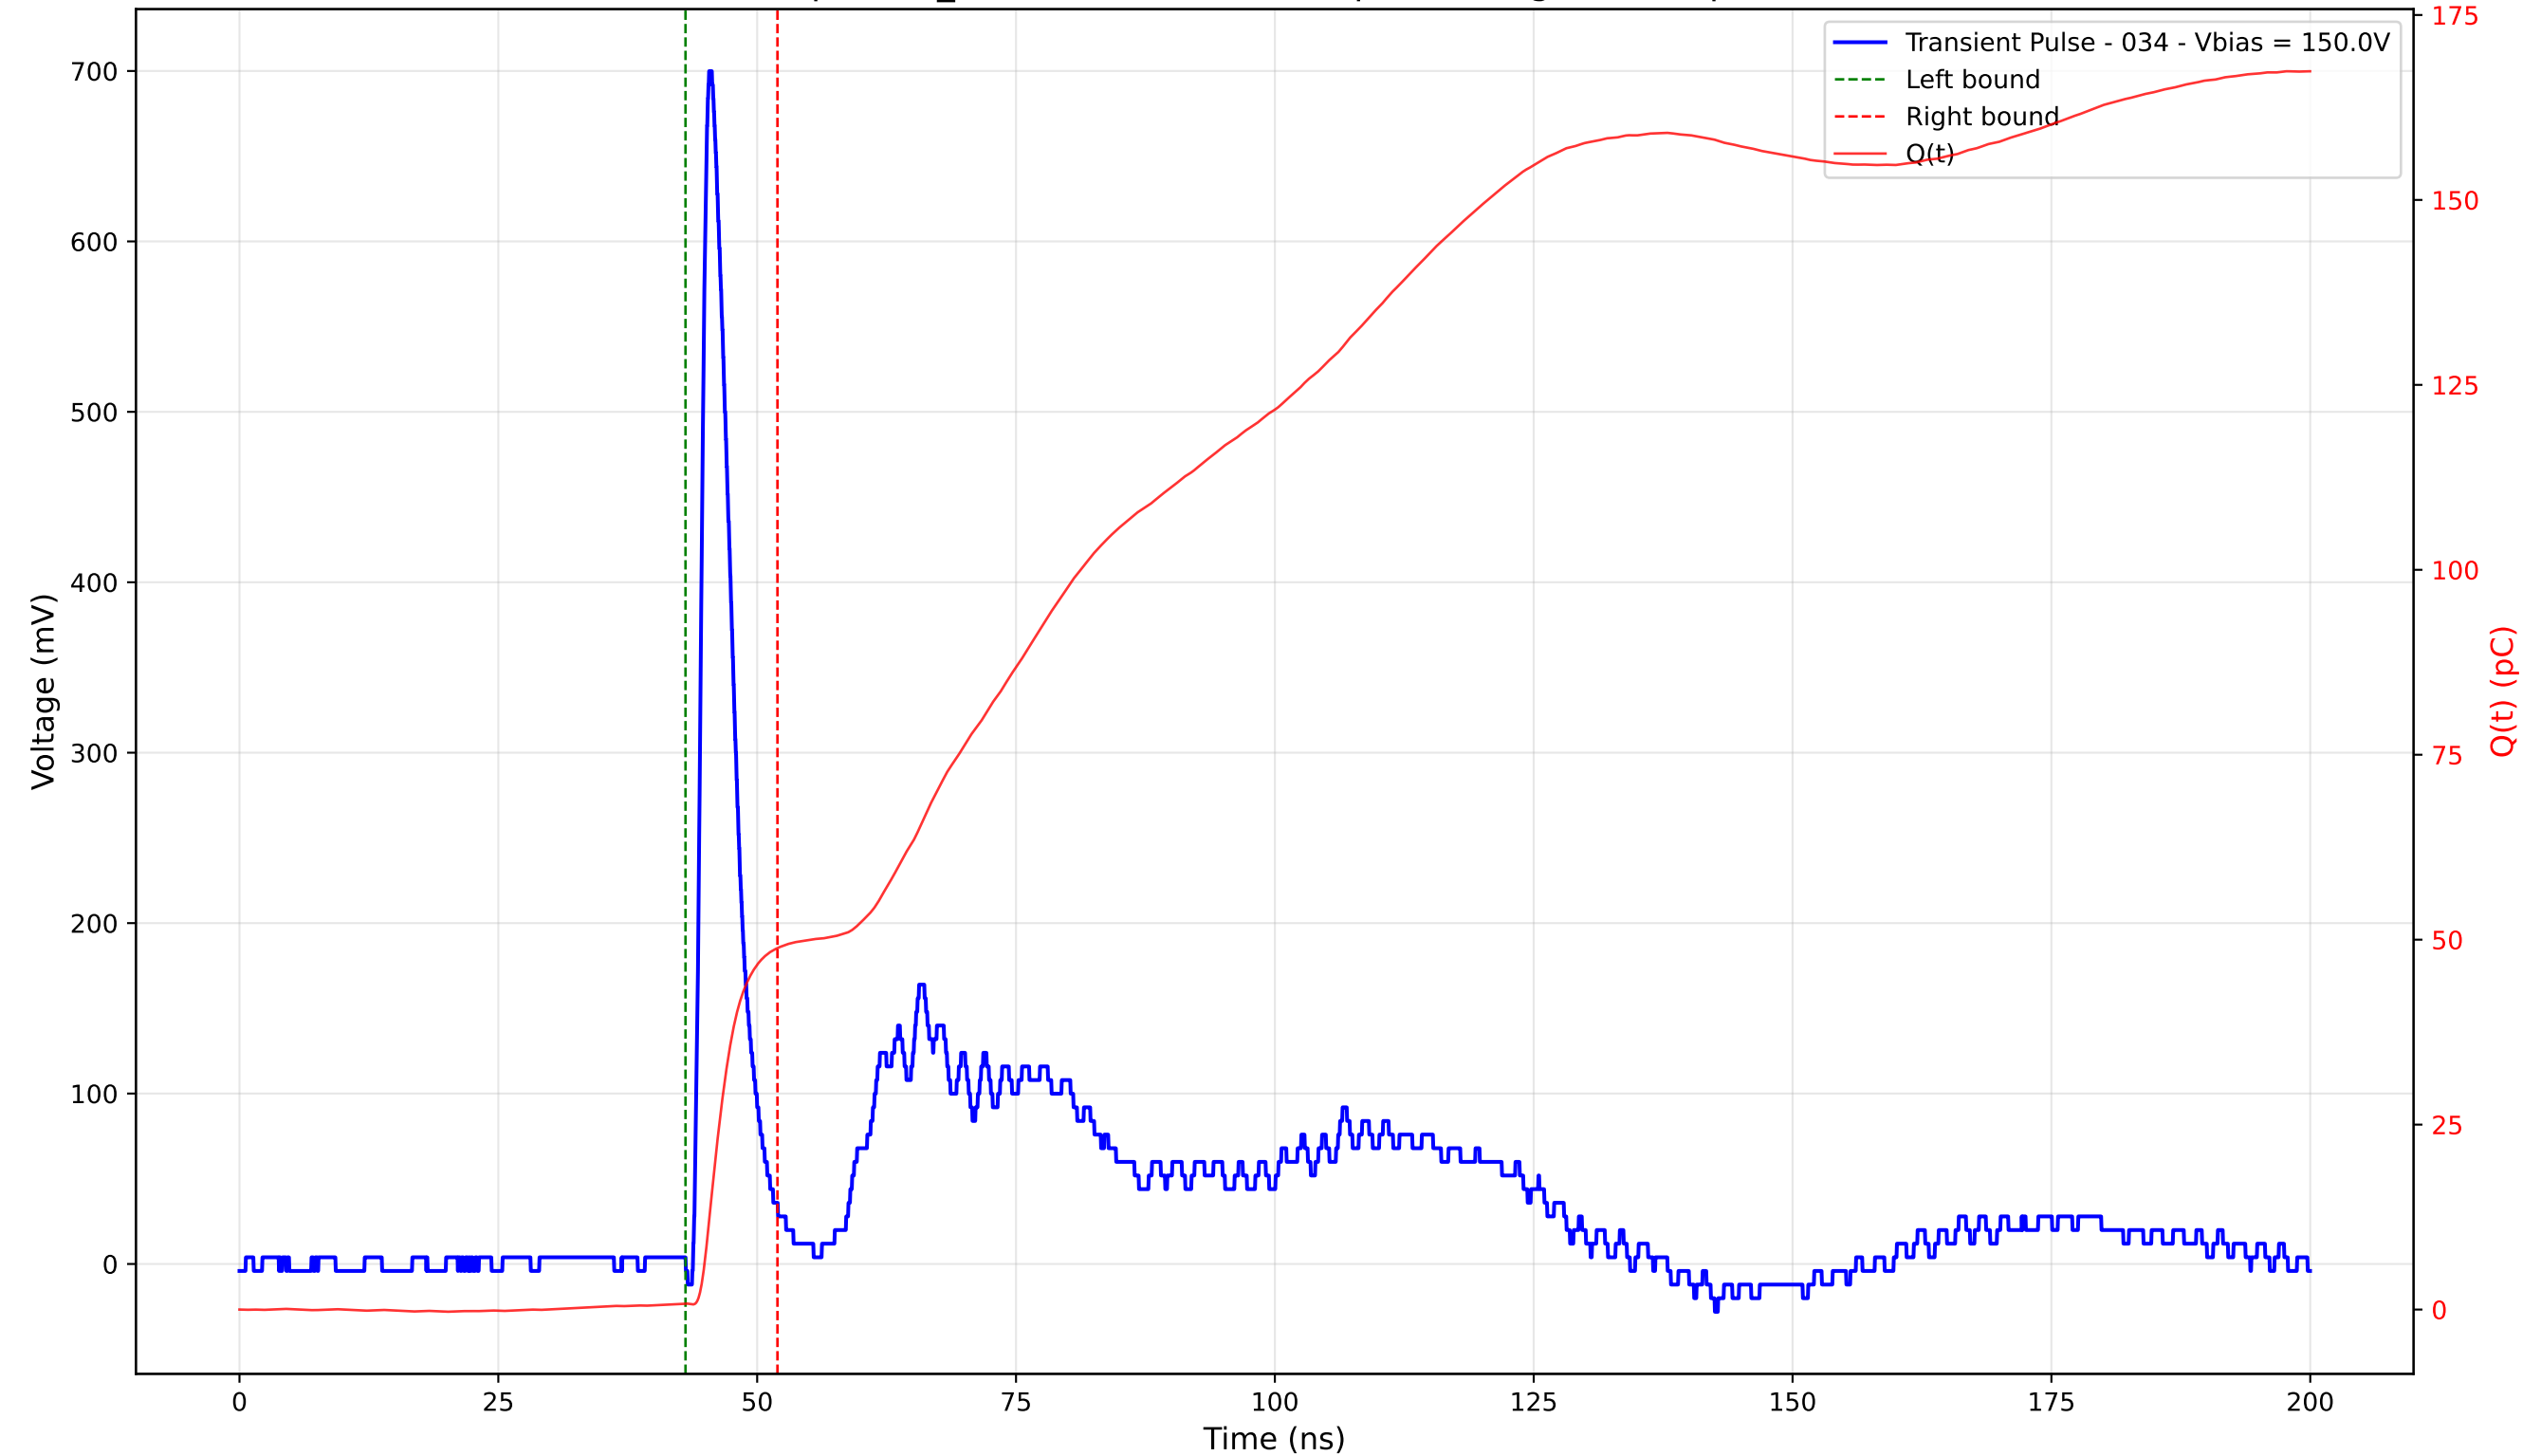


Transient Pulse - Sample: TD_4004 - Position: 230.0 μm - Charge: 44.63 pC - Rise Time: 0.98 ns

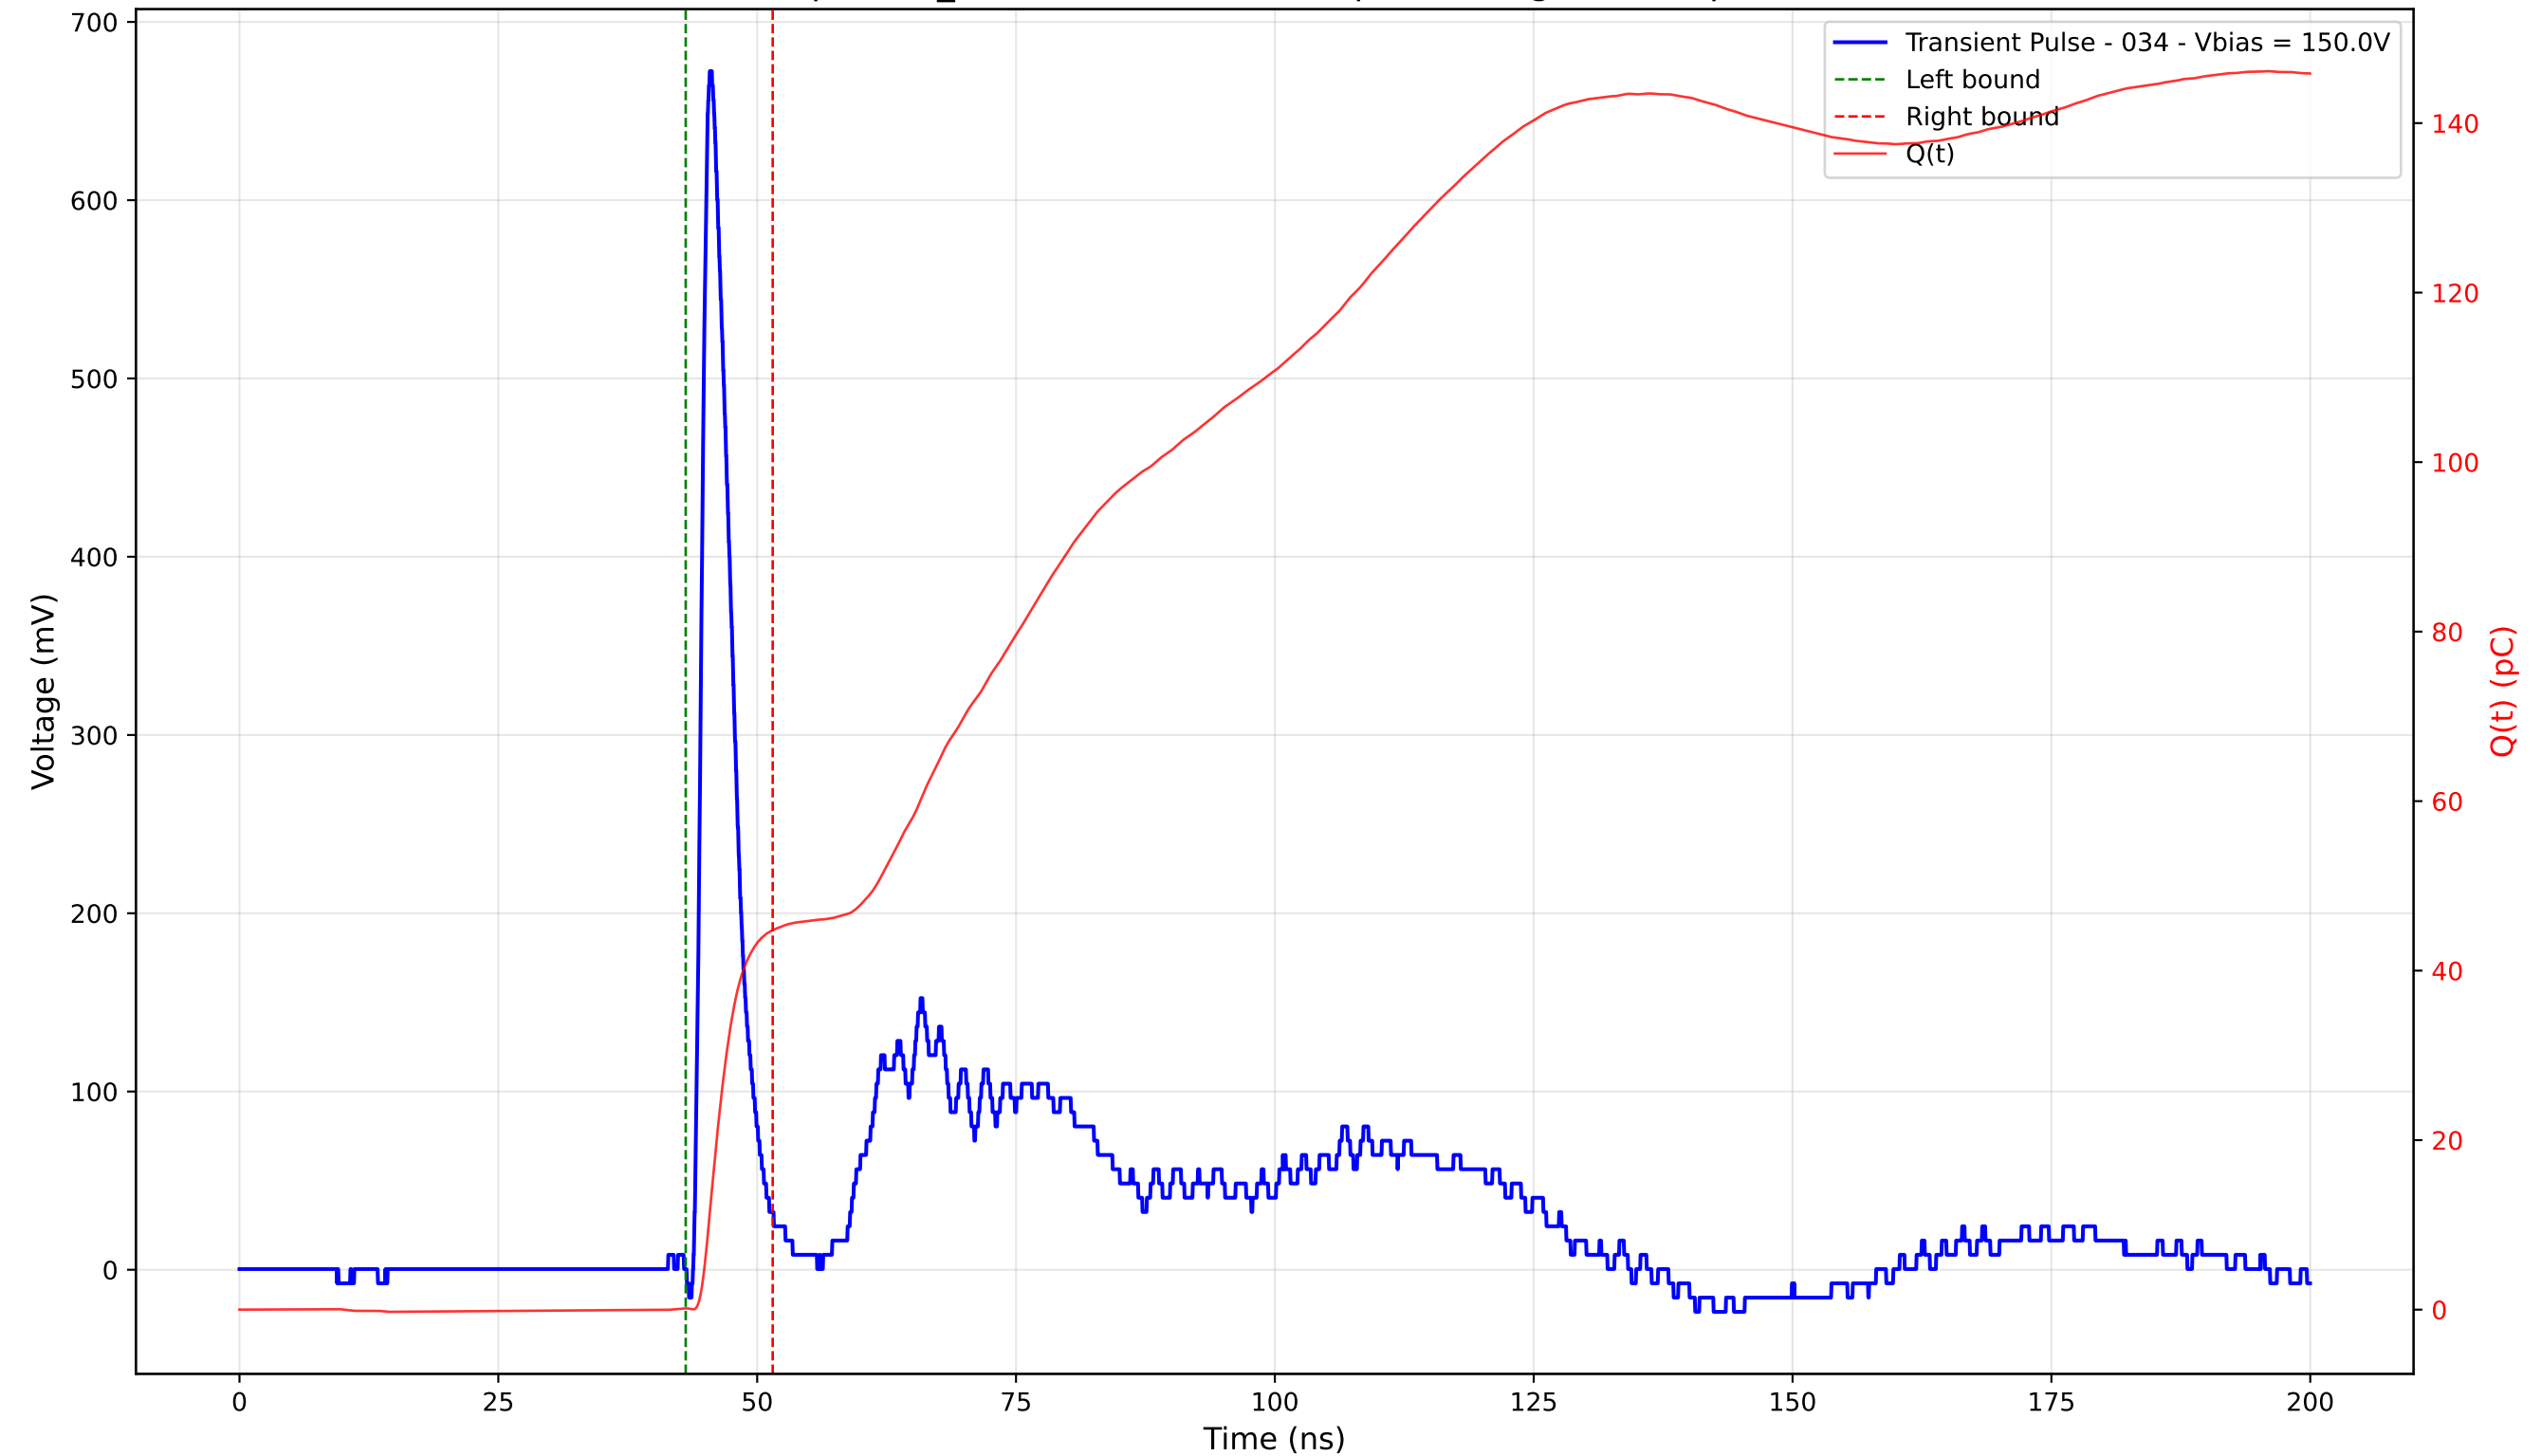


Transient Pulse - Sample: TD_4004 - Position: 235.0 μm - Charge: 42.12 pC - Rise Time: 1.02 ns

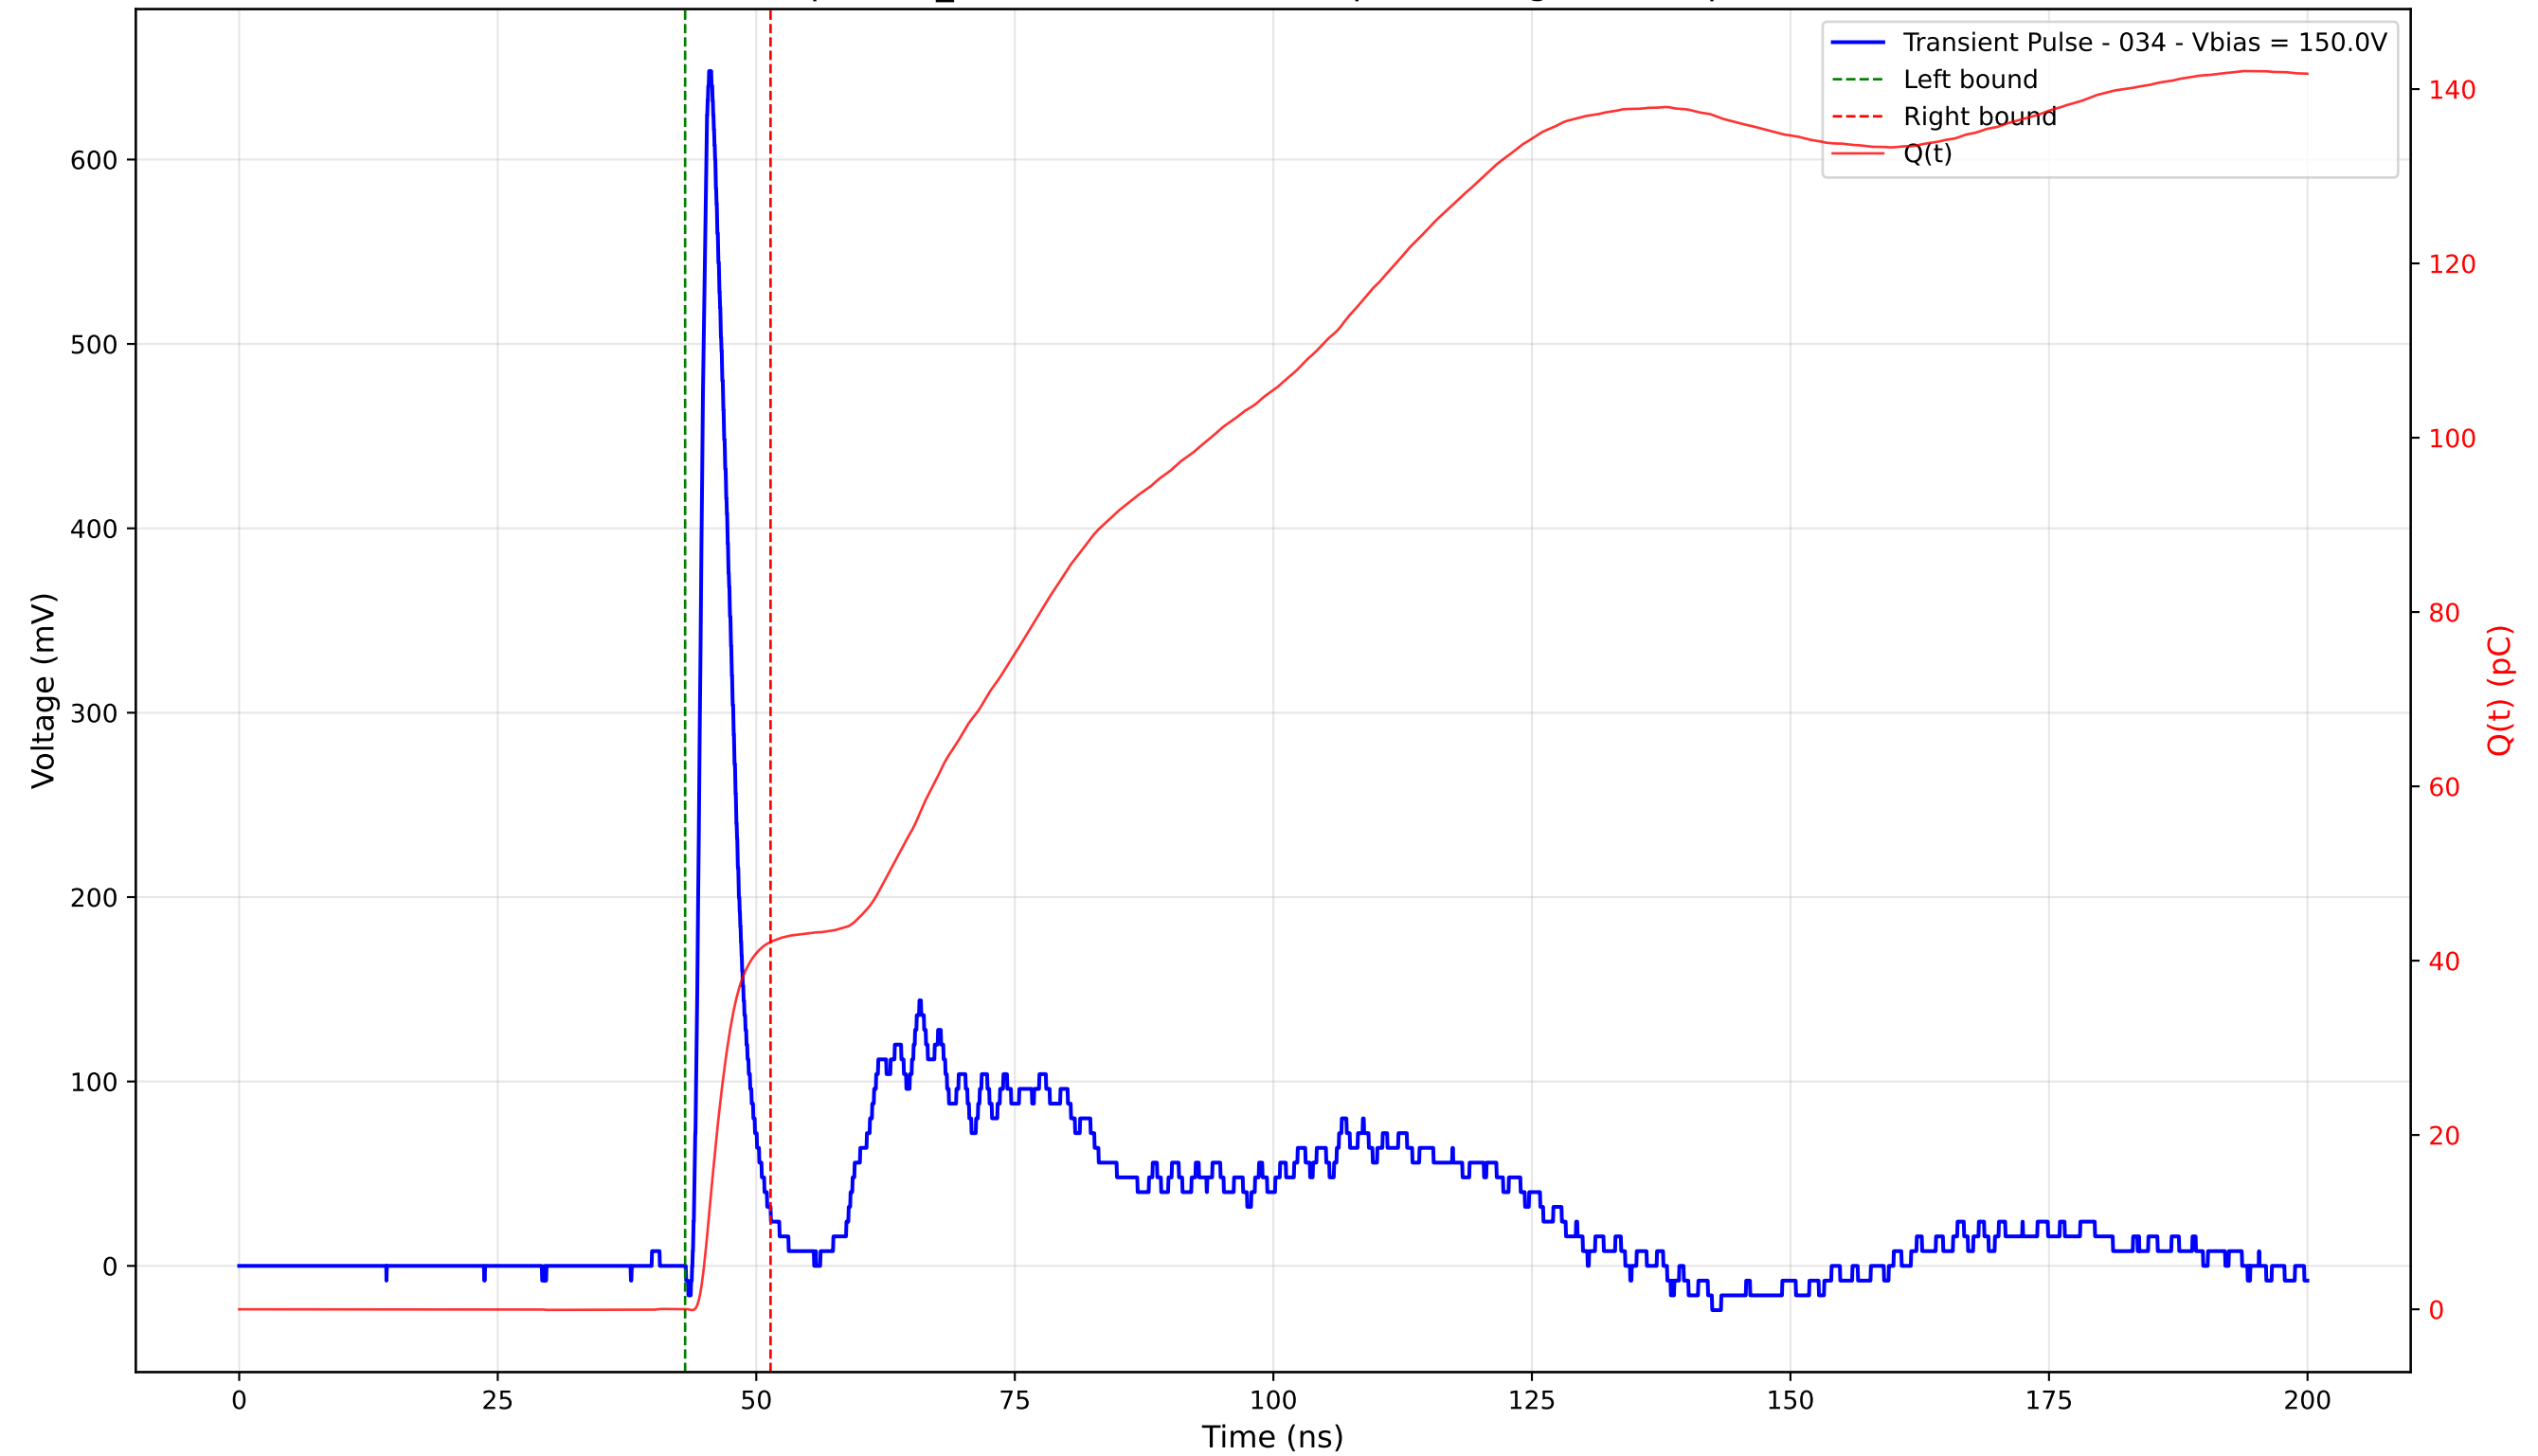


Transient Pulse - Sample: TD_4004 - Position: 240.0 μm - Charge: 40.70 pC - Rise Time: 1.00 ns

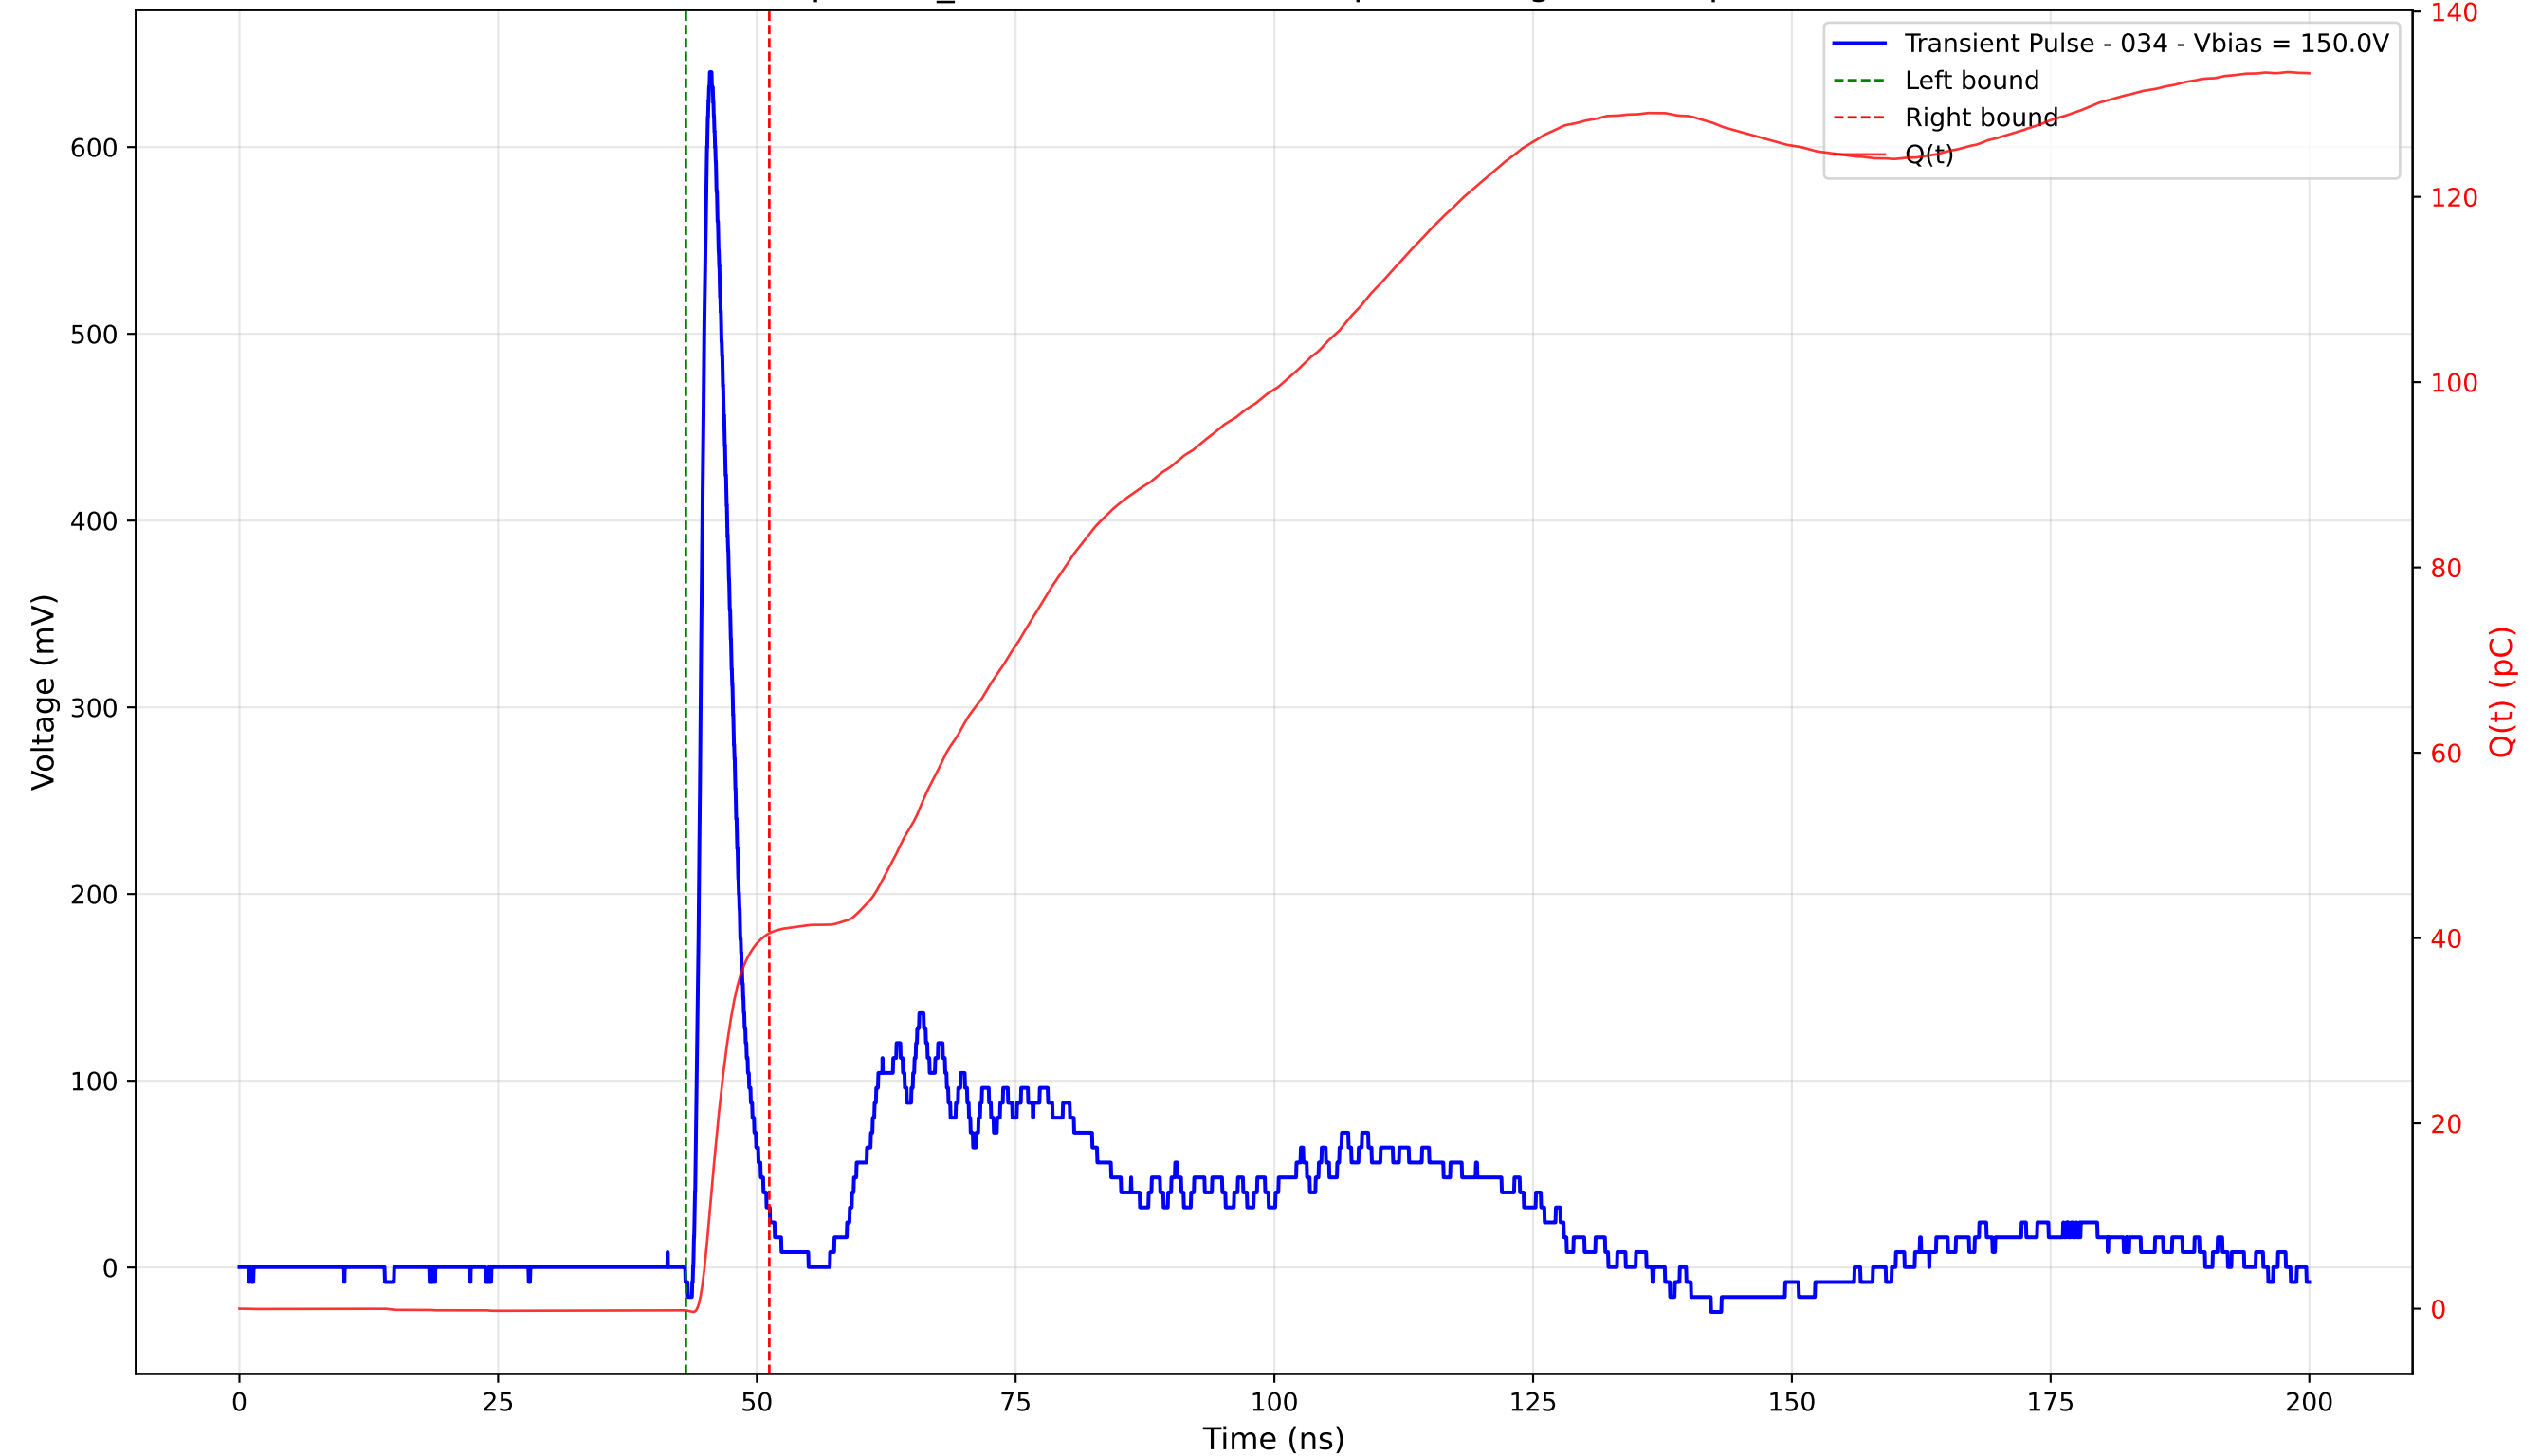


Transient Pulse - Sample: TD_4004 - Position: 245.0 μm - Charge: 41.06 pC - Rise Time: 1.04 ns

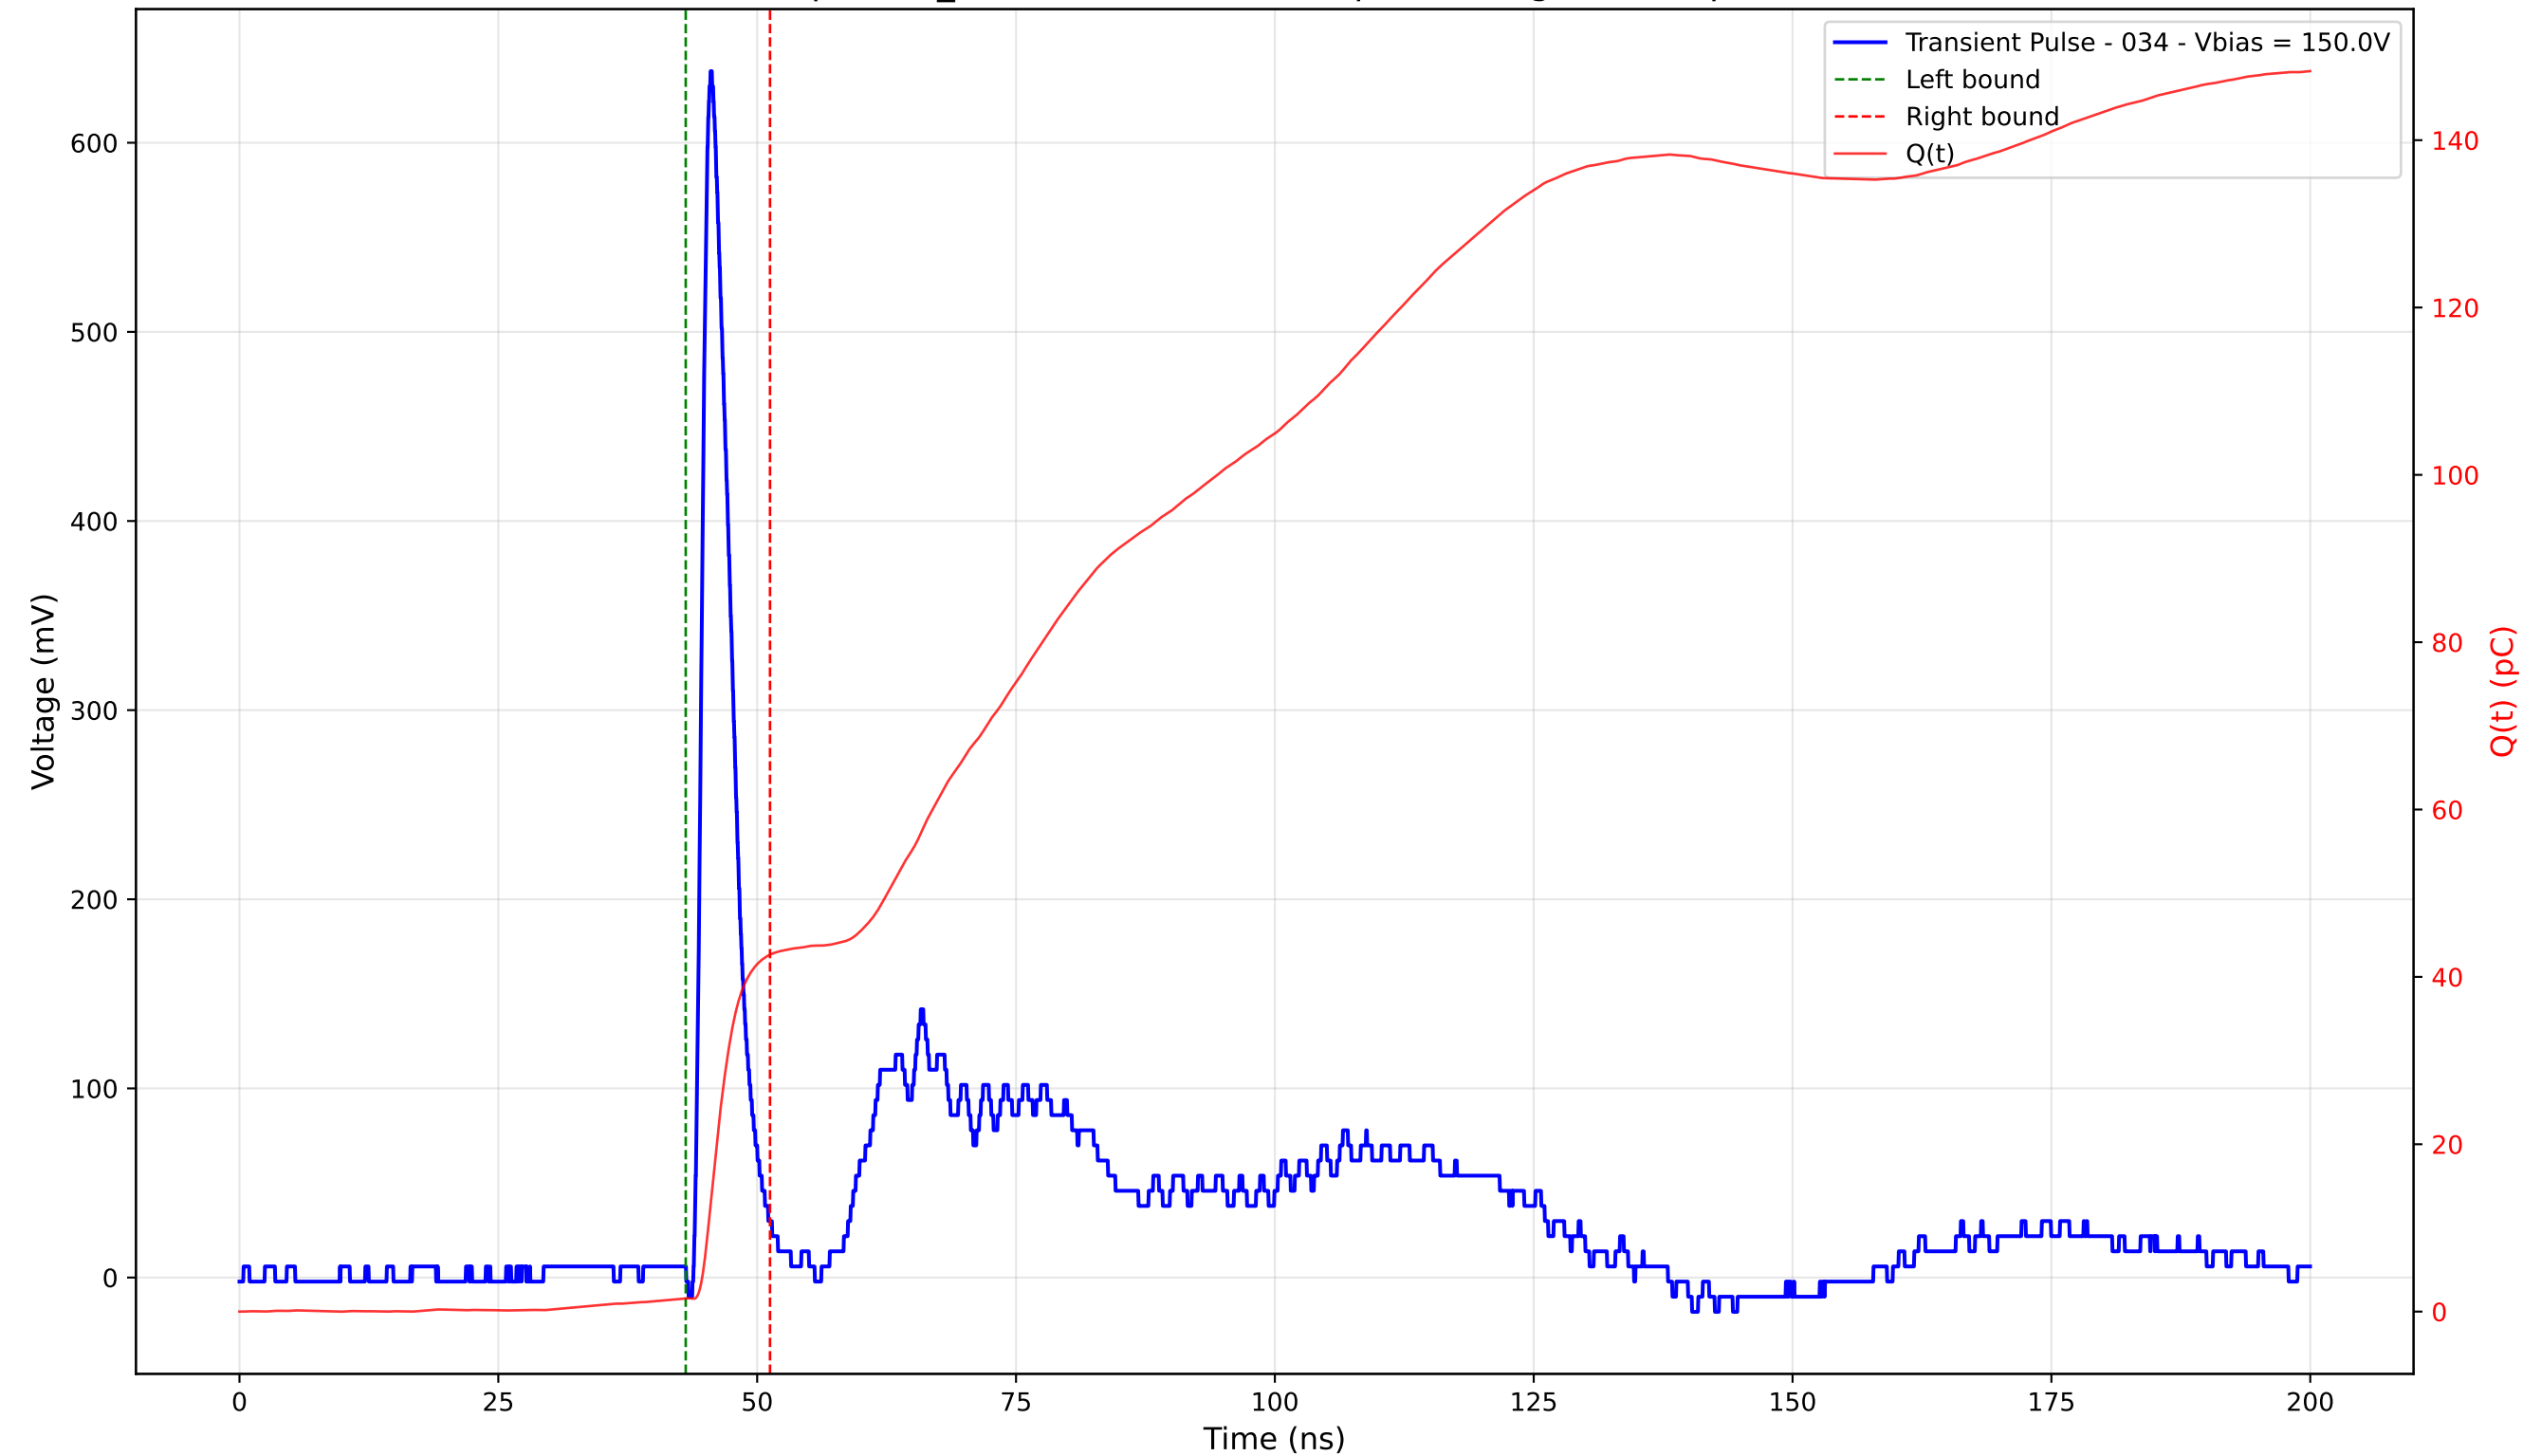


Transient Pulse - Sample: TD_4004 - Position: 250.0 μm - Charge: 40.65 pC - Rise Time: 1.03 ns

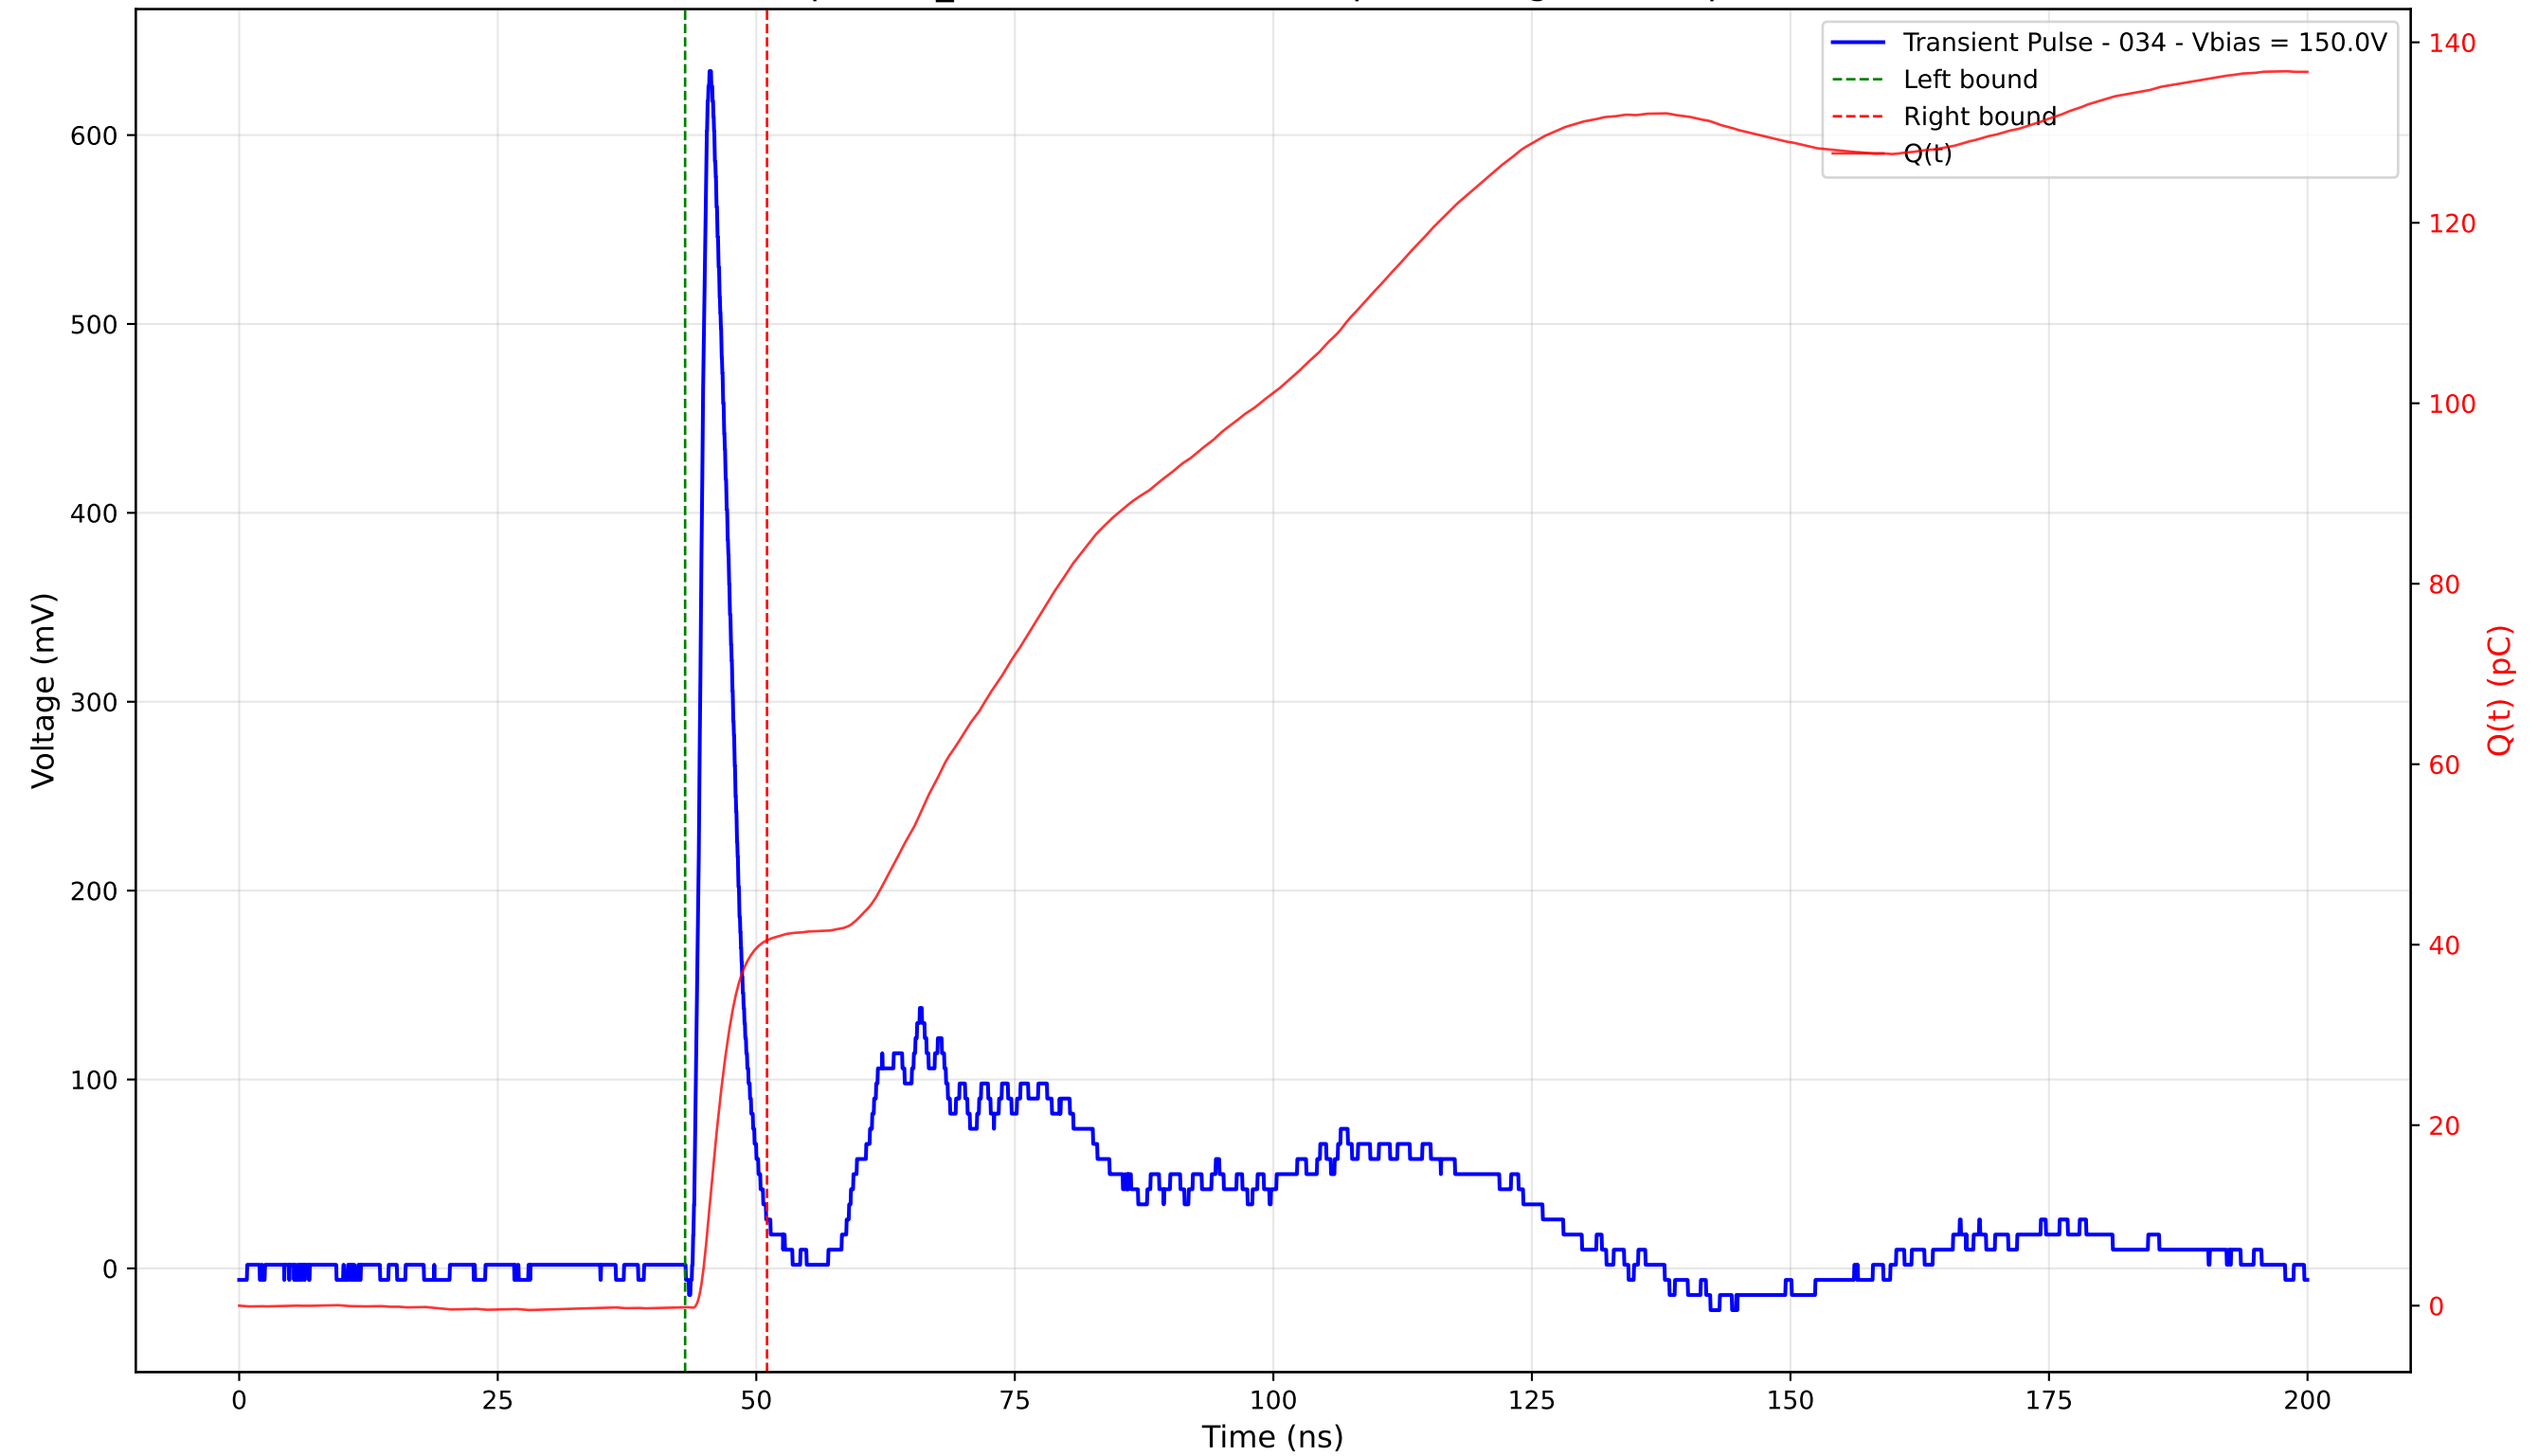


Transient Pulse - Sample: TD_4004 - Position: 255.0 μm - Charge: 40.50 pC - Rise Time: 1.02 ns

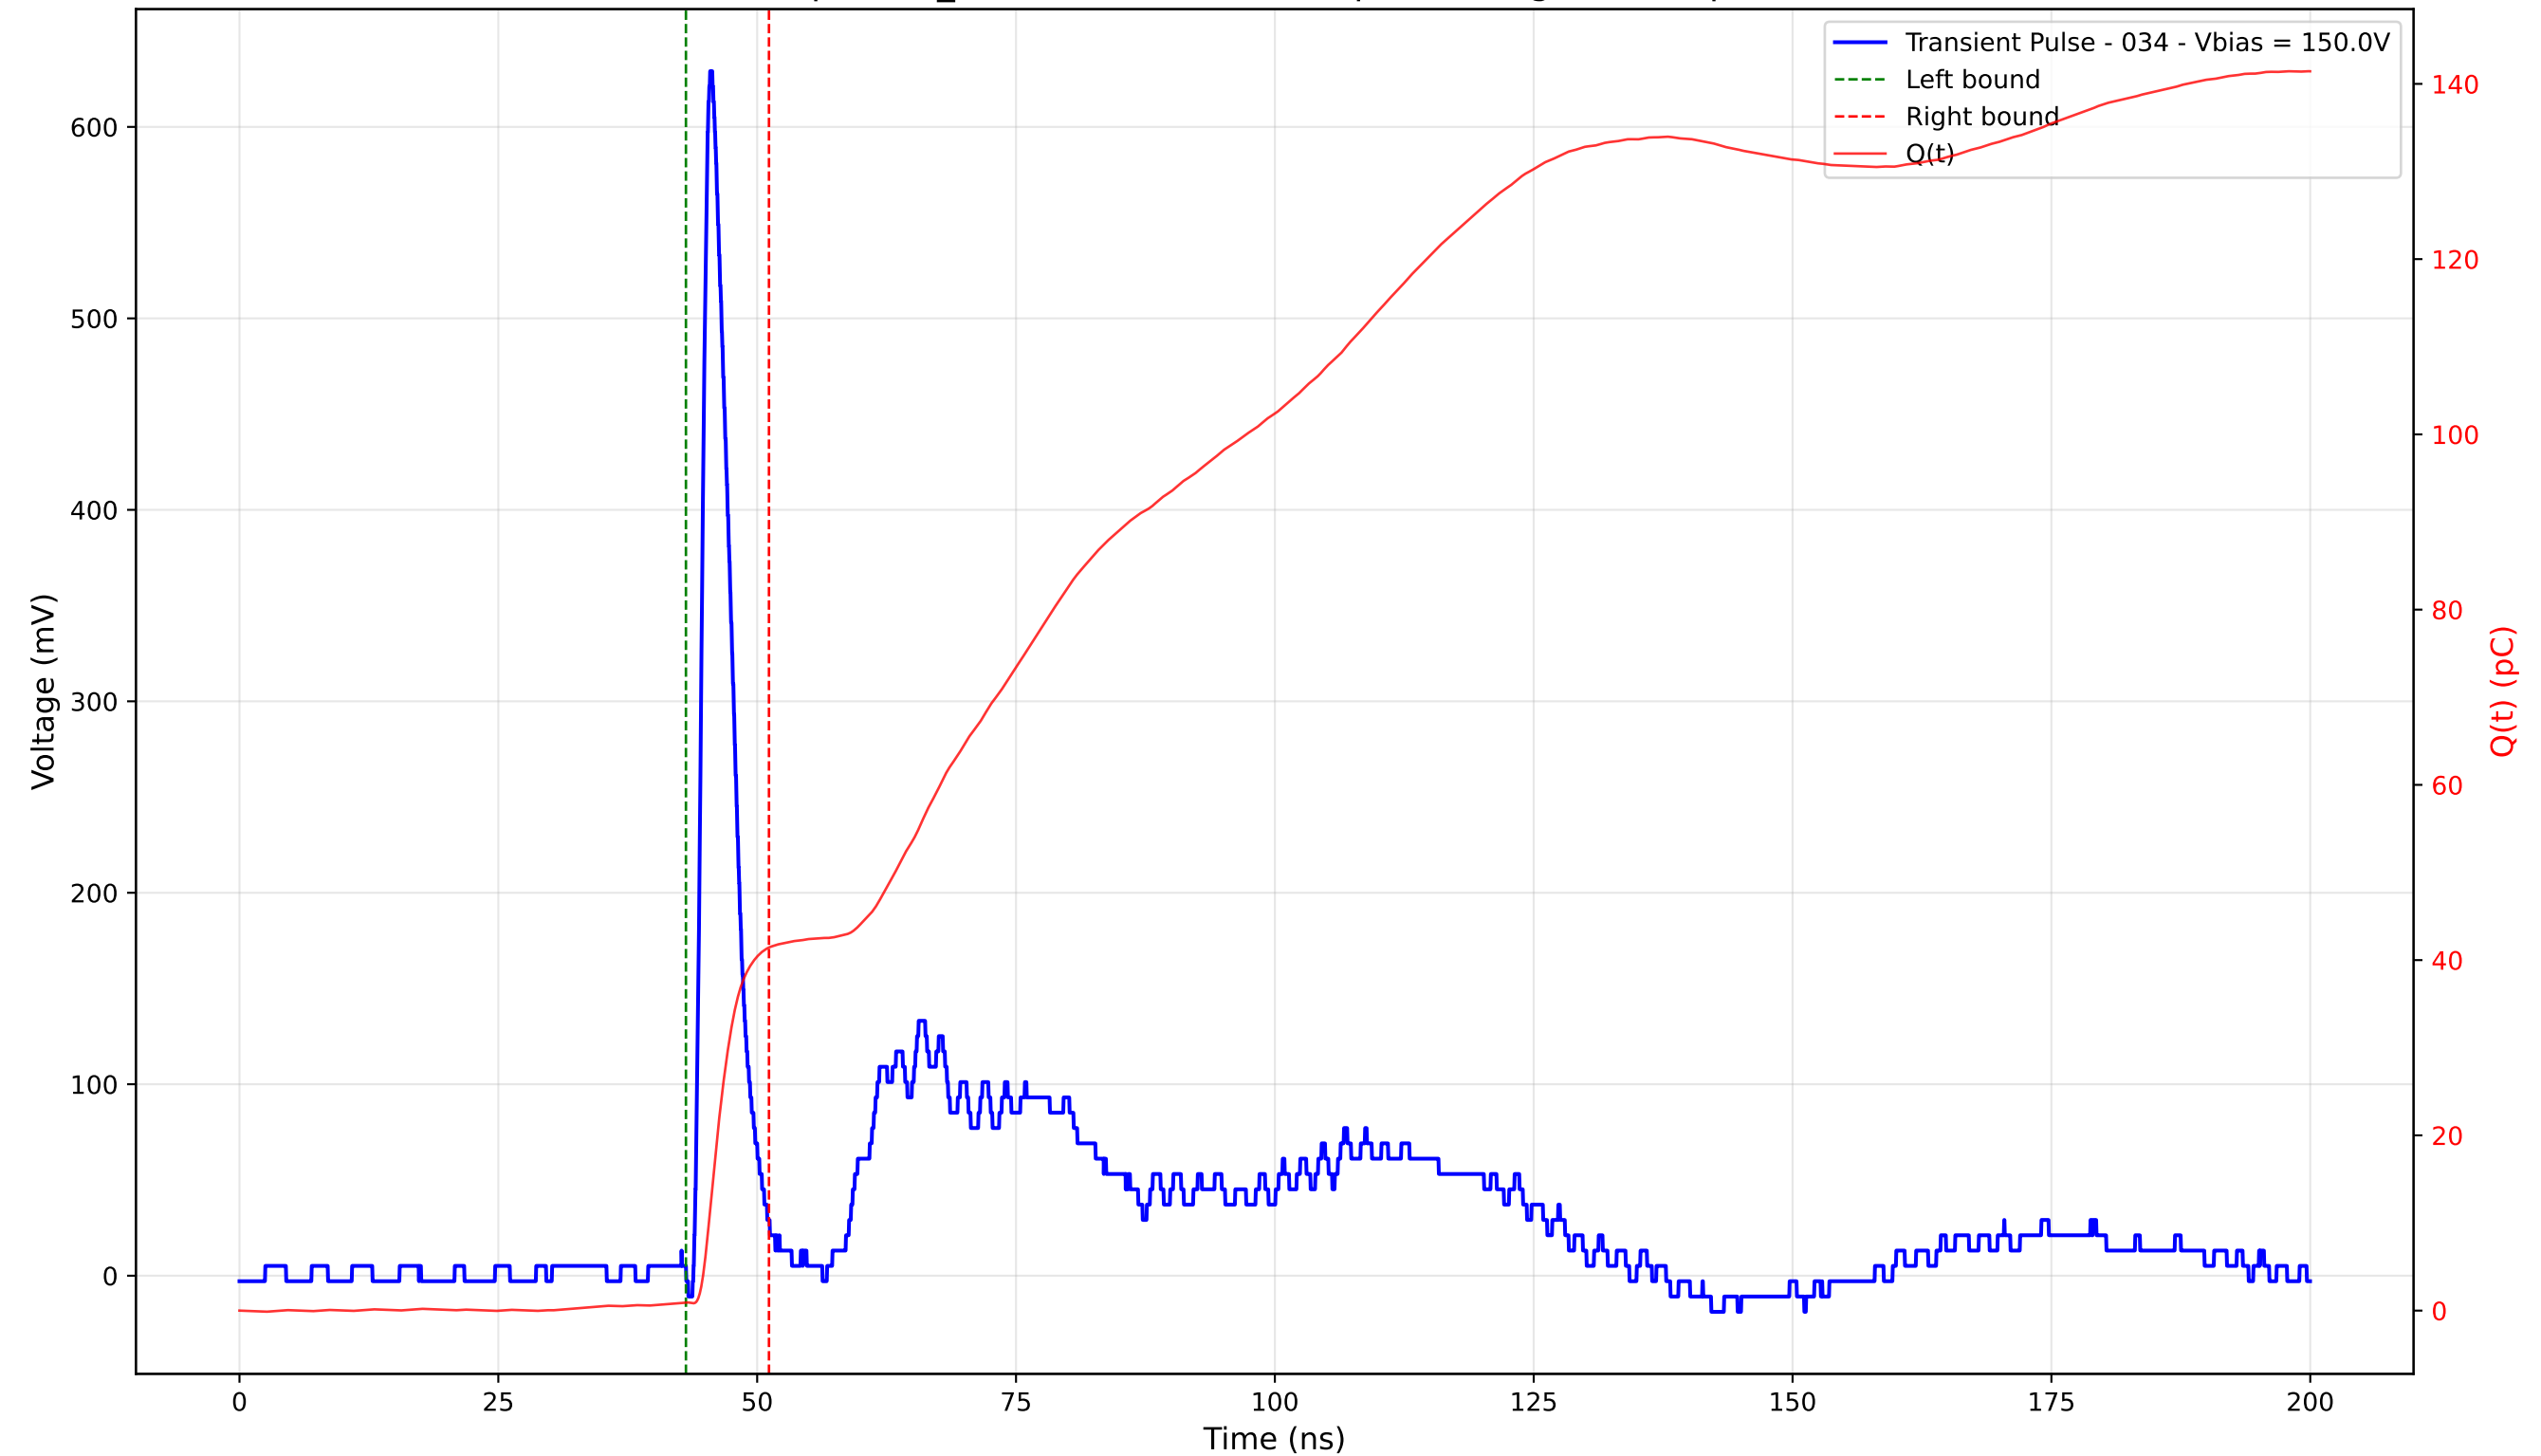


Transient Pulse - Sample: TD_4004 - Position: 260.0 μm - Charge: 38.56 pC - Rise Time: 1.05 ns

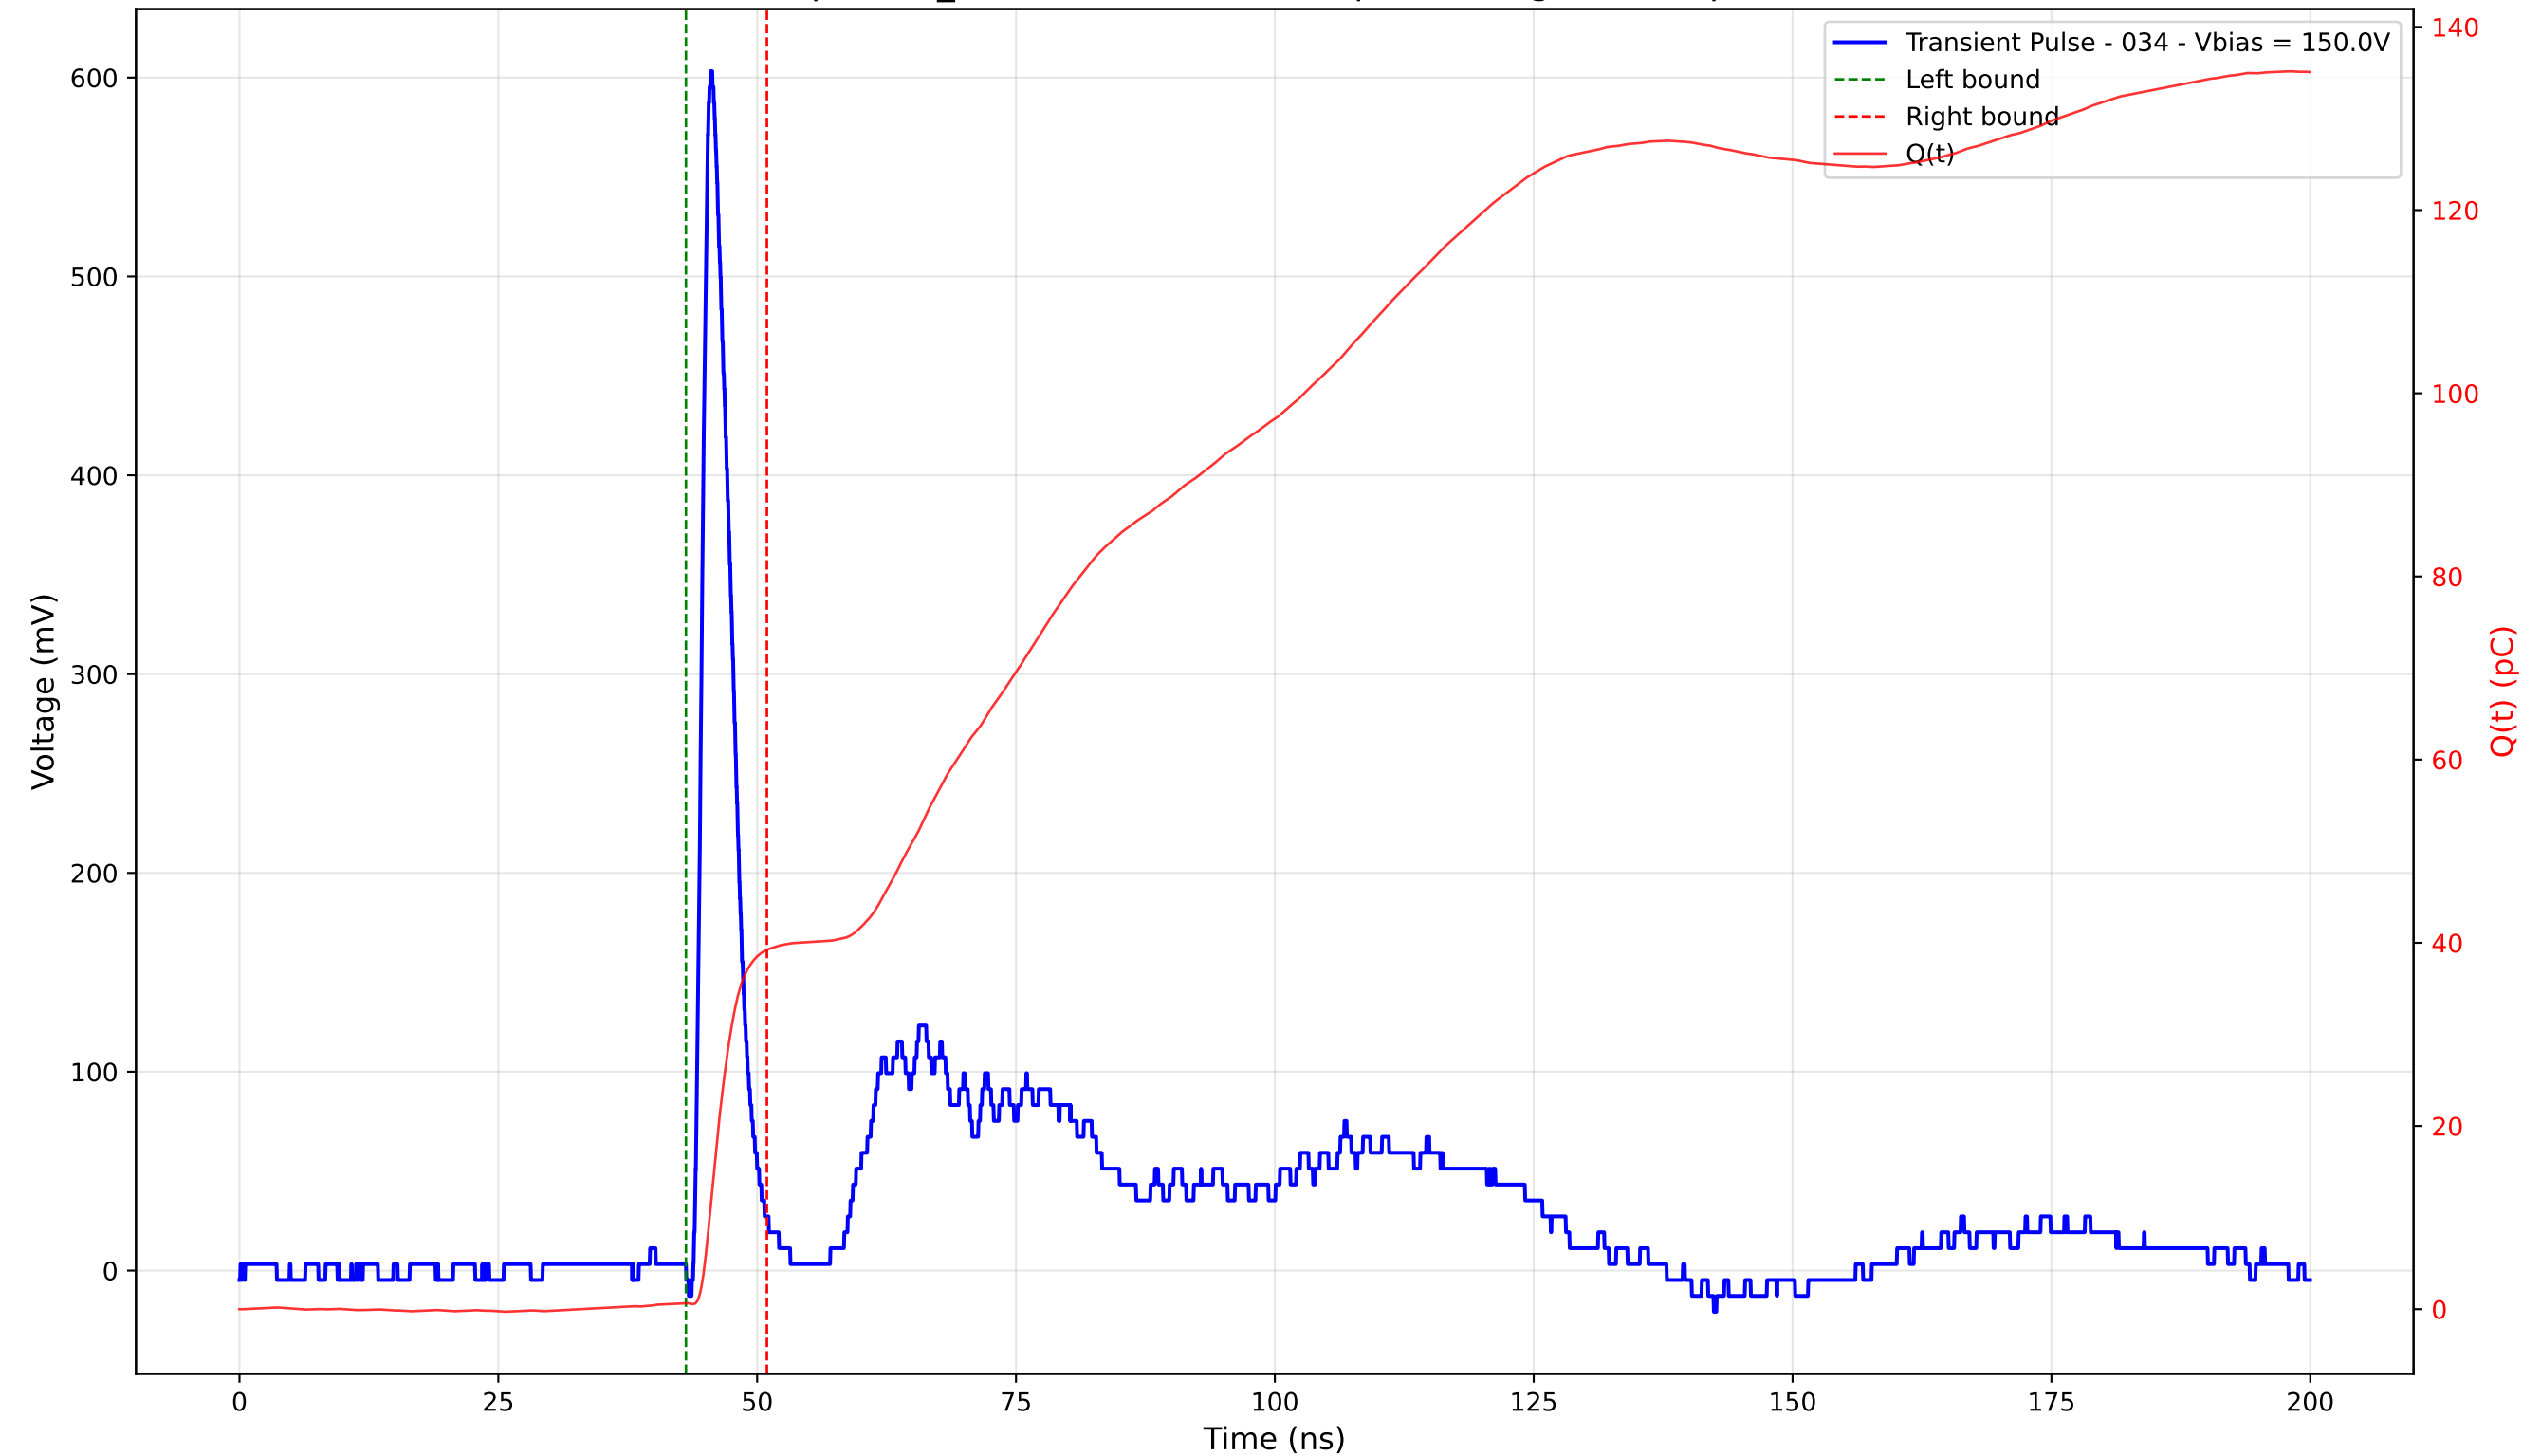


Transient Pulse - Sample: TD_4004 - Position: 265.0 μm - Charge: 38.03 pC - Rise Time: 1.04 ns

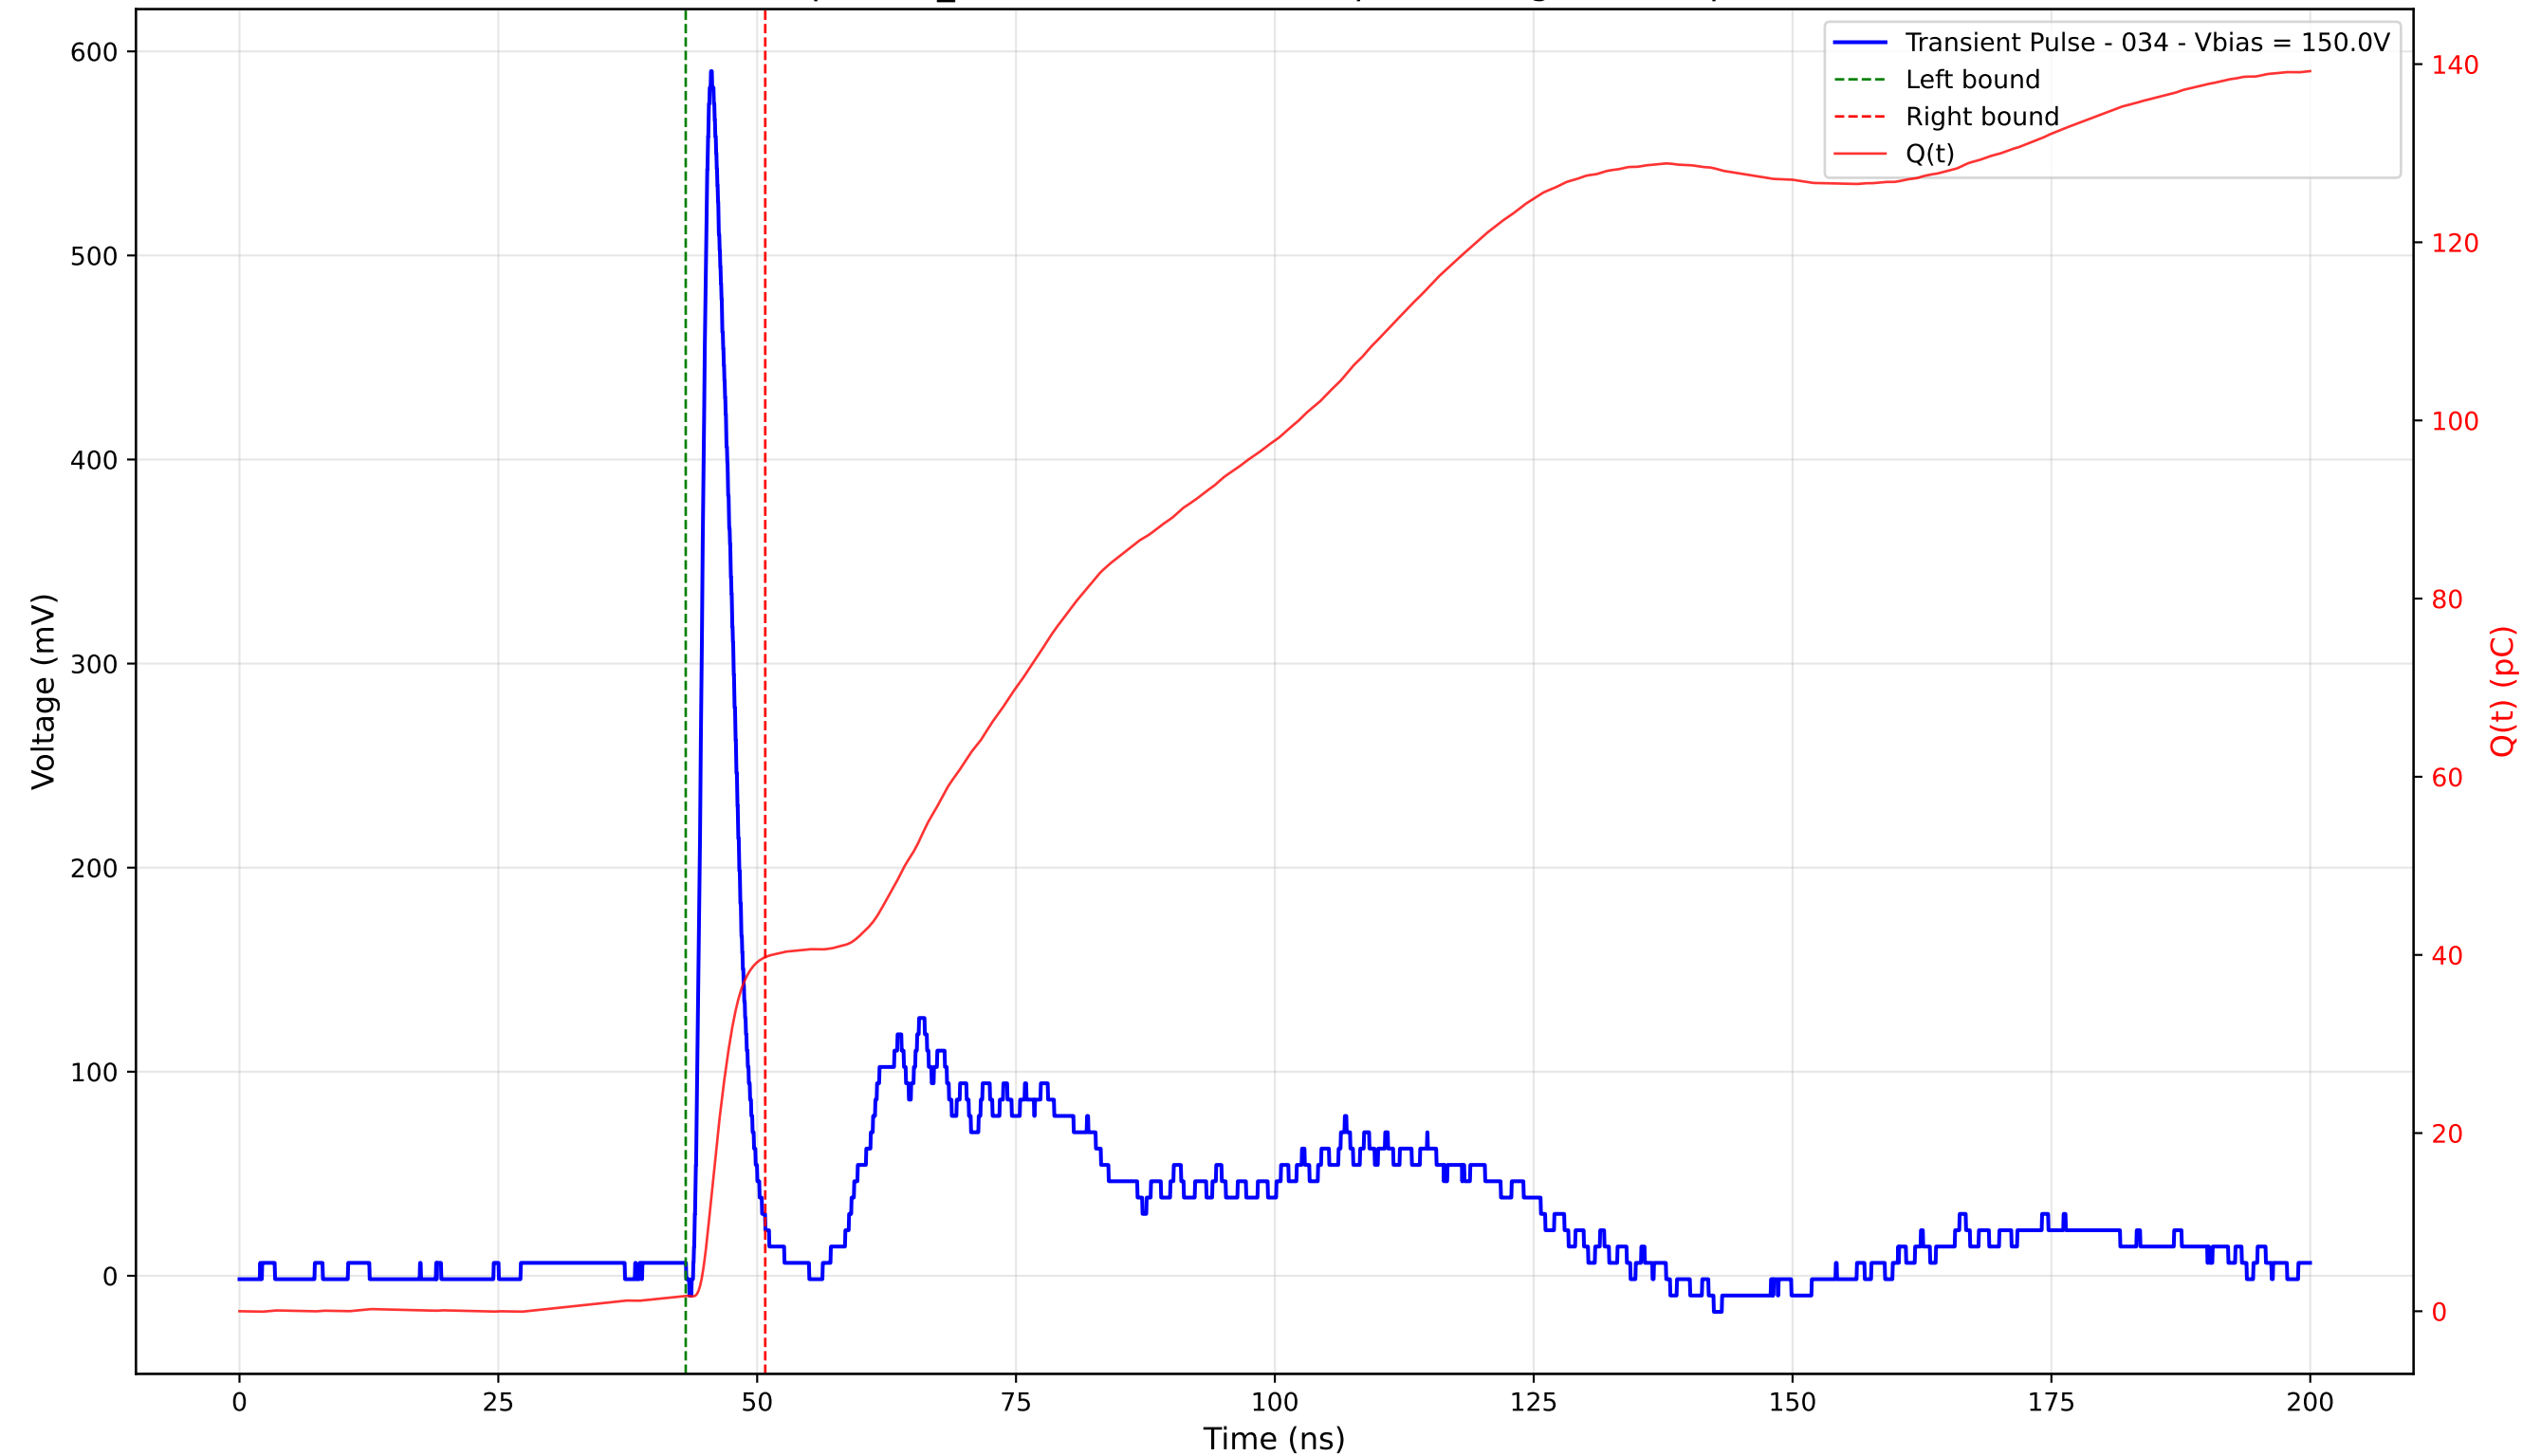


Transient Pulse - Sample: TD_4004 - Position: 270.0 μm - Charge: 38.81 pC - Rise Time: 1.03 ns

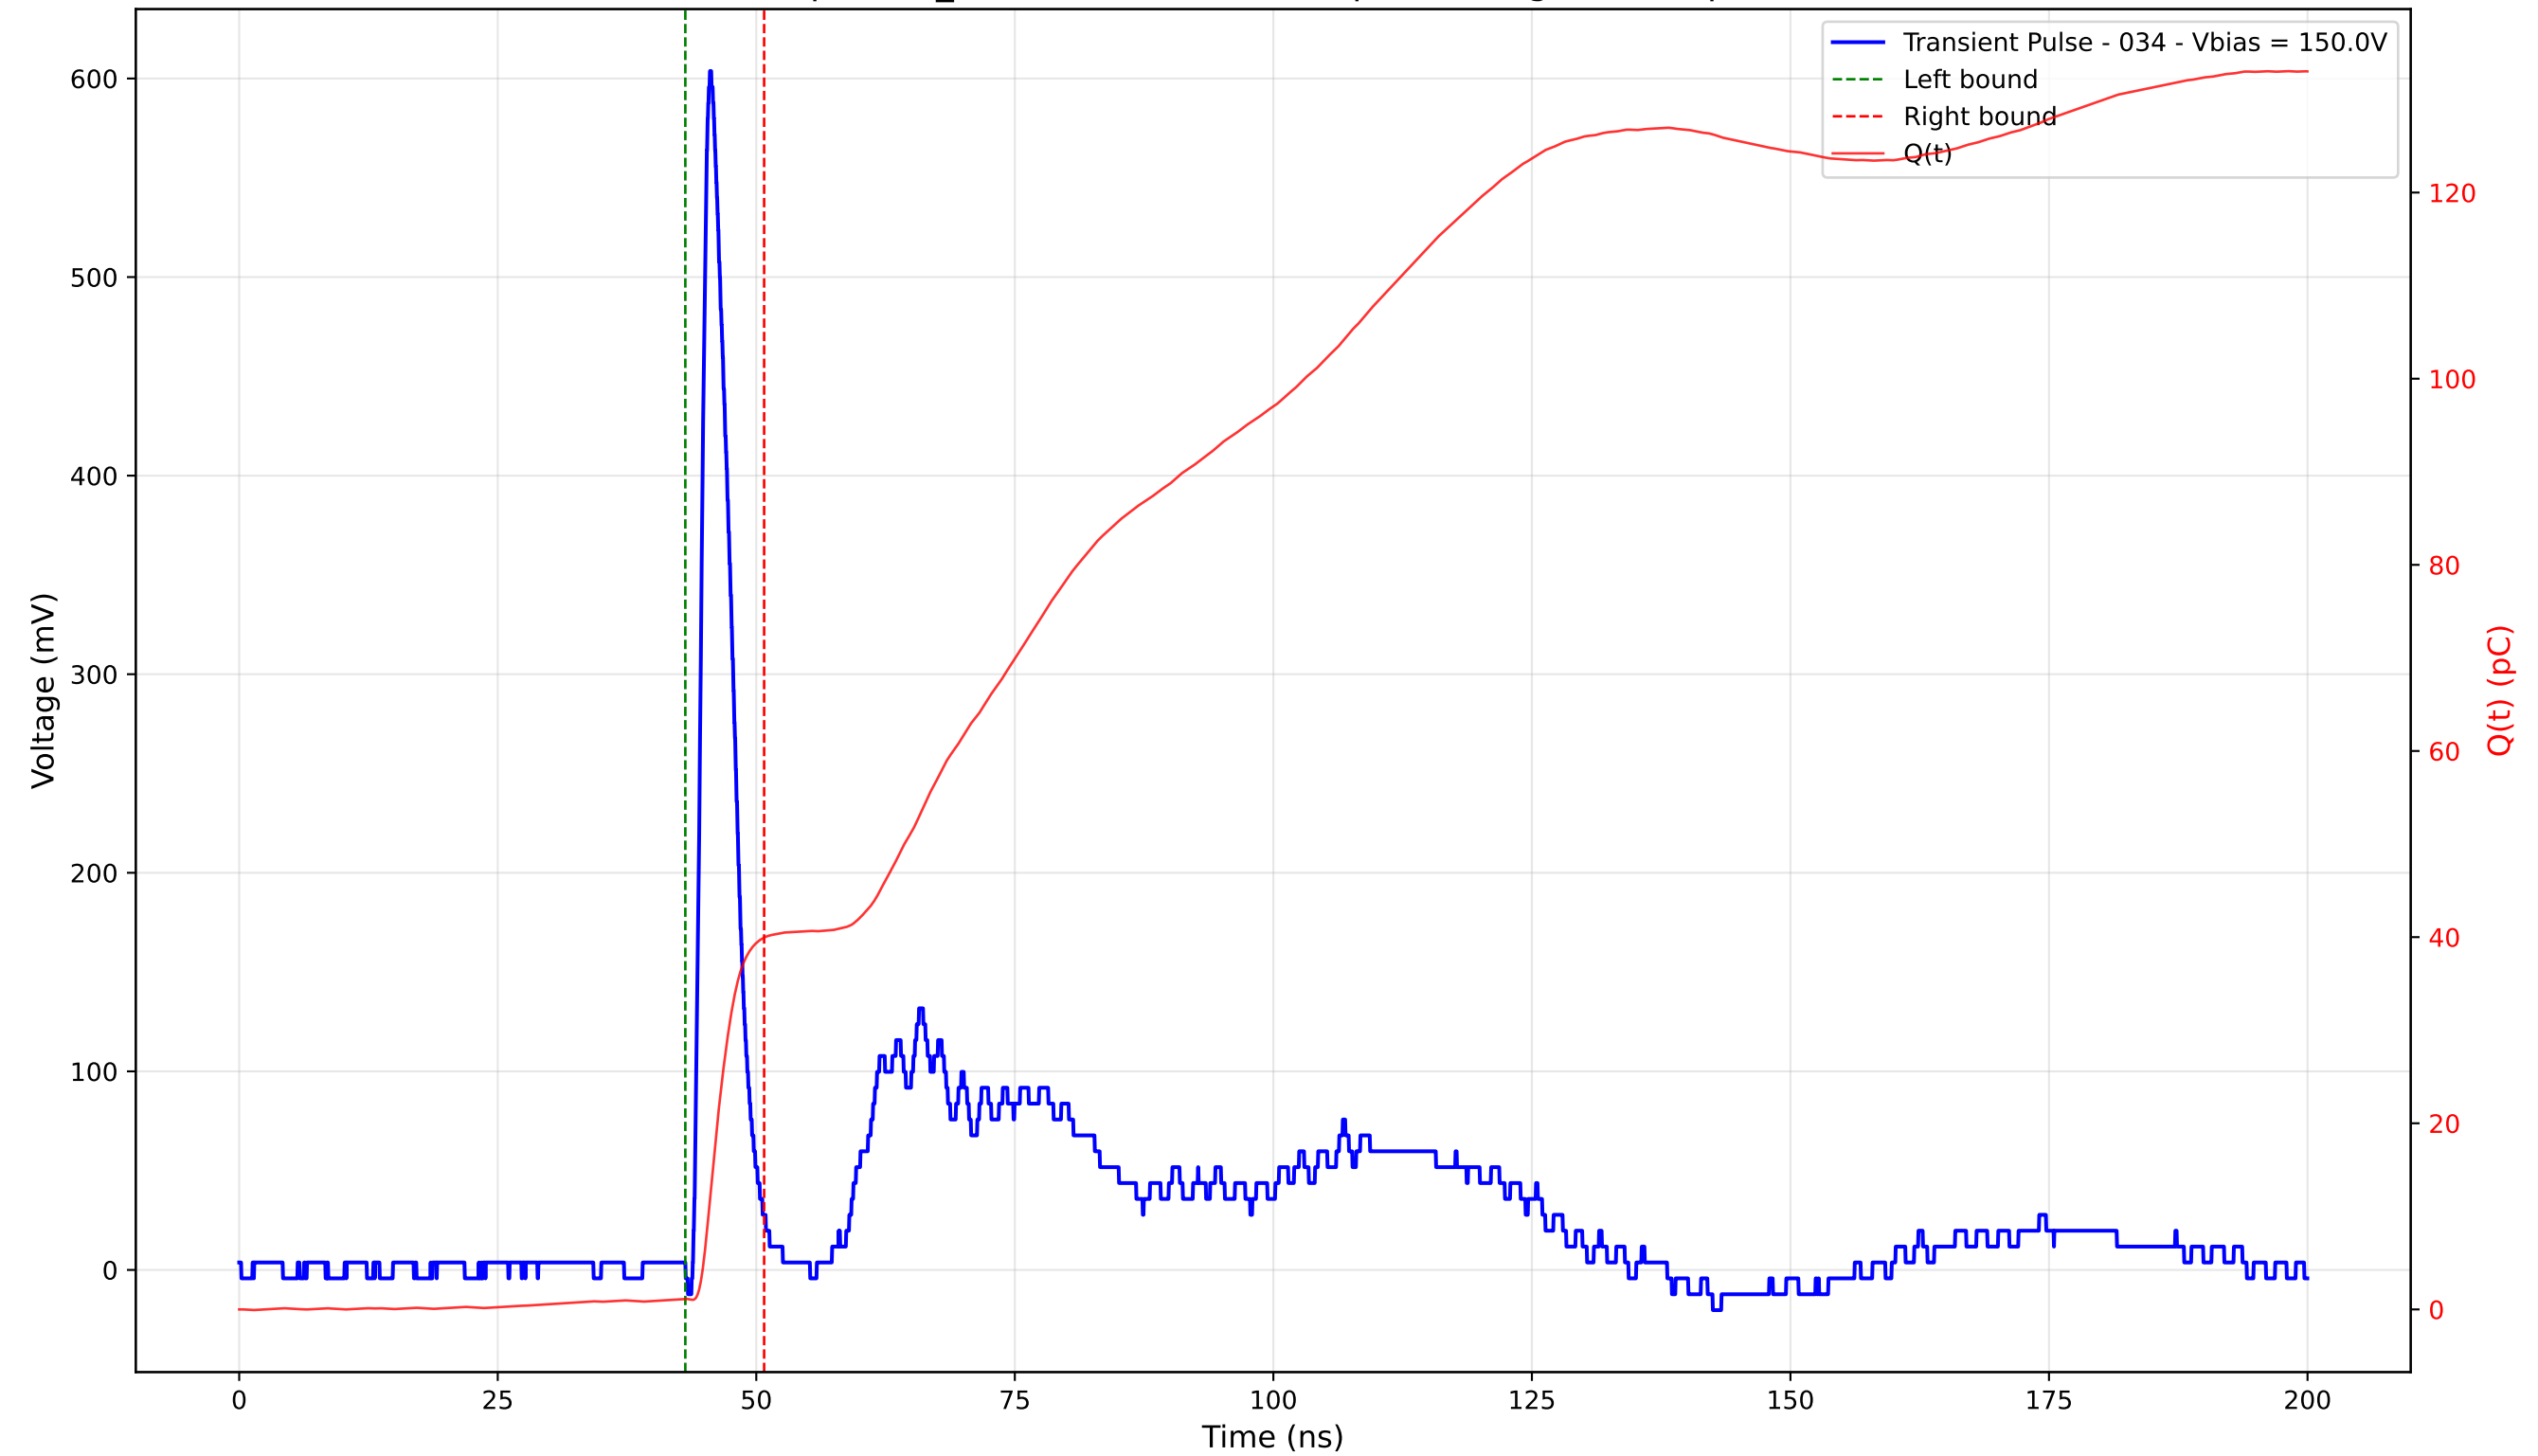


Transient Pulse - Sample: TD_4004 - Position: 275.0 μm - Charge: 39.62 pC - Rise Time: 1.01 ns

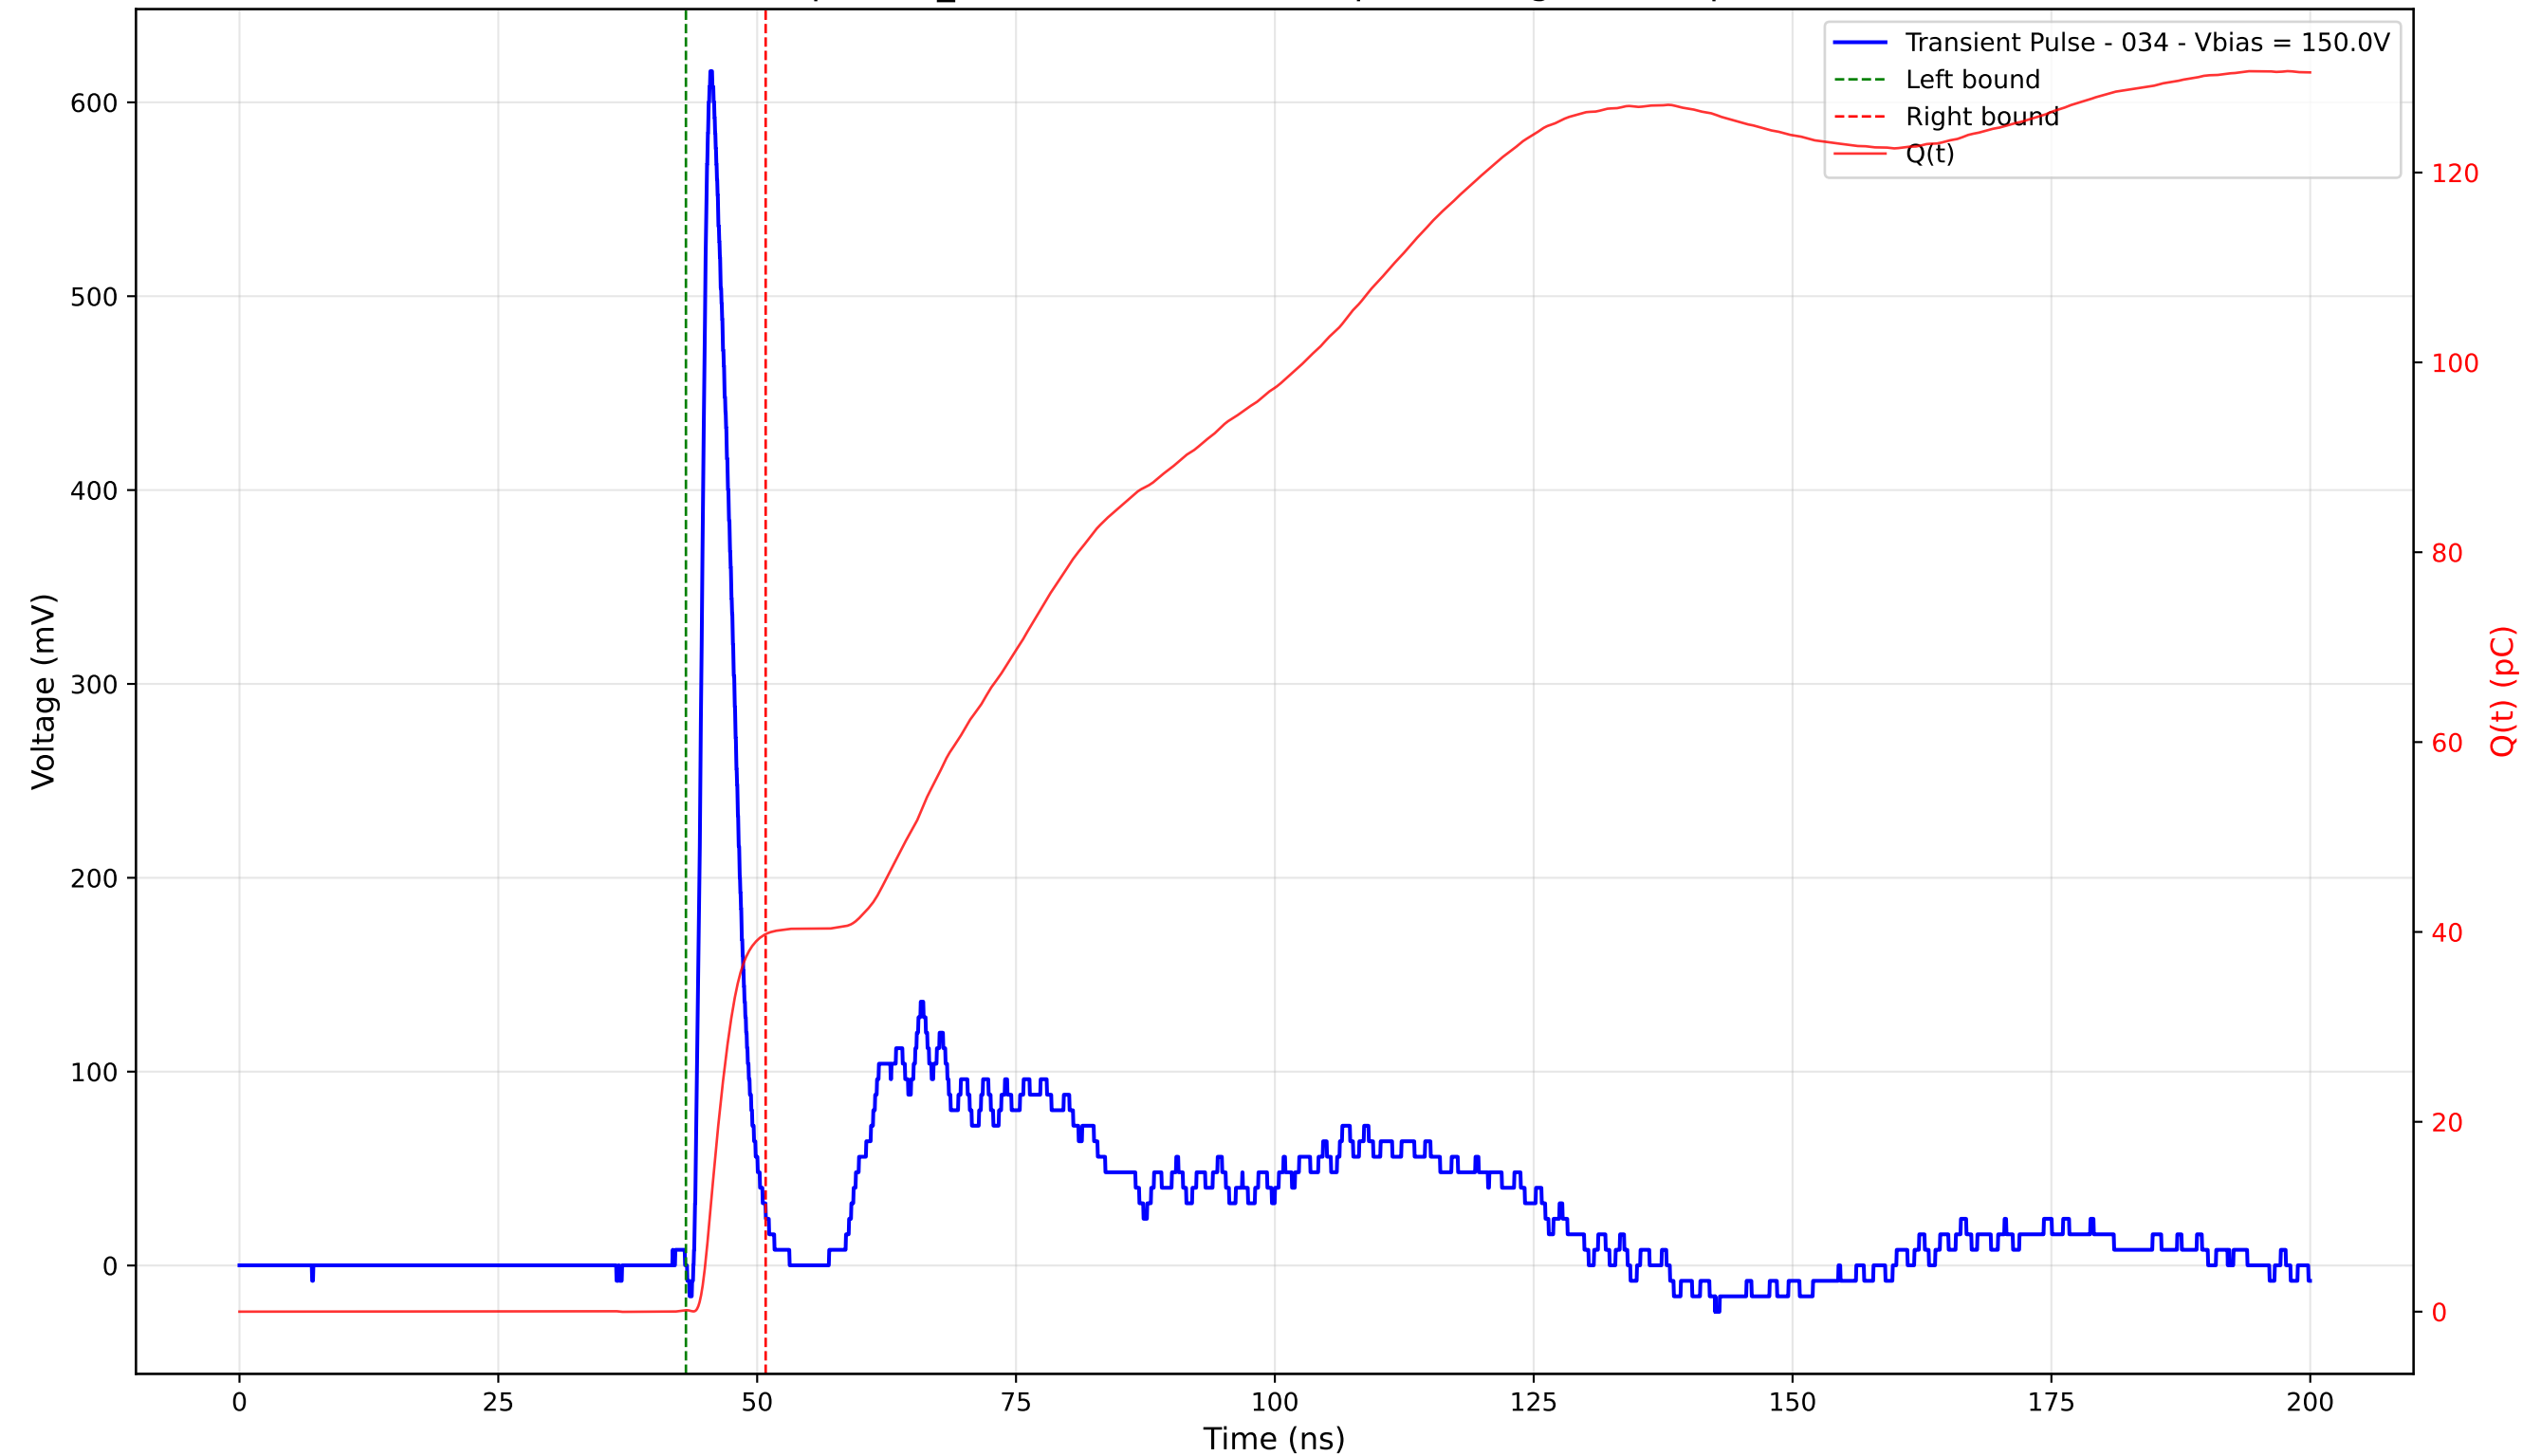


Transient Pulse - Sample: TD_4004 - Position: 280.0 μm - Charge: 39.99 pC - Rise Time: 1.03 ns

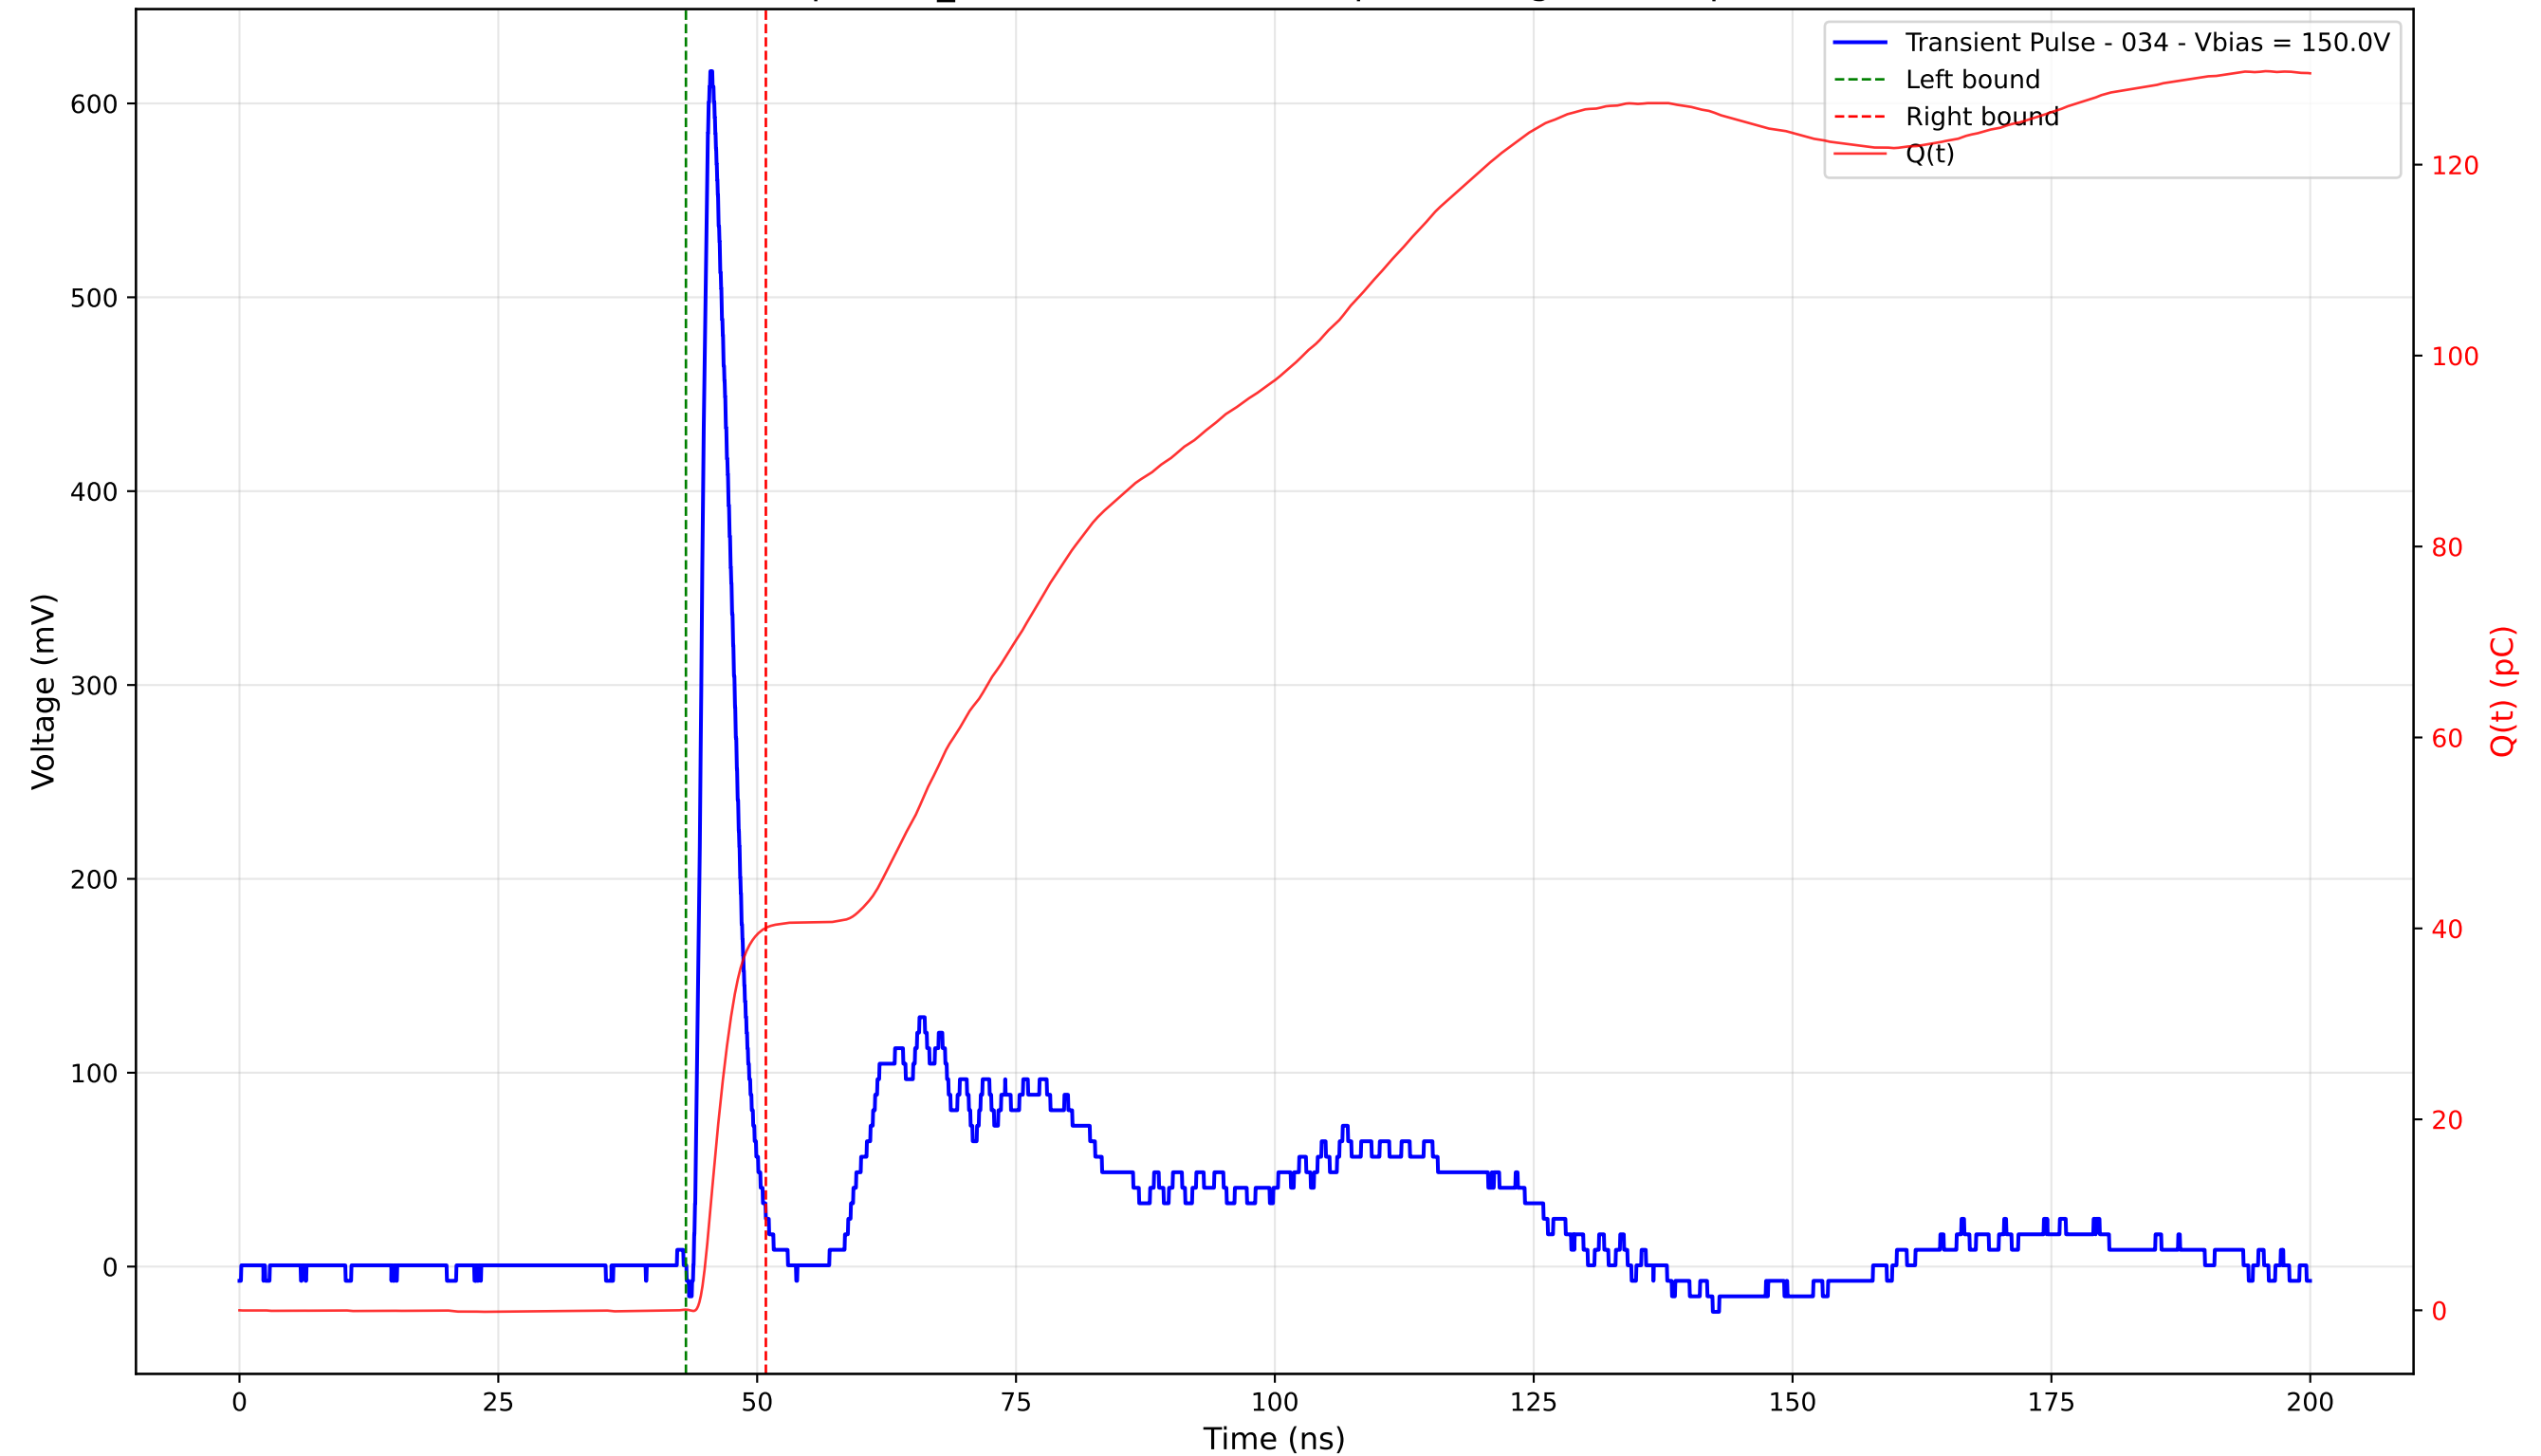


Transient Pulse - Sample: TD_4004 - Position: 285.0 μm - Charge: 39.67 pC - Rise Time: 1.03 ns

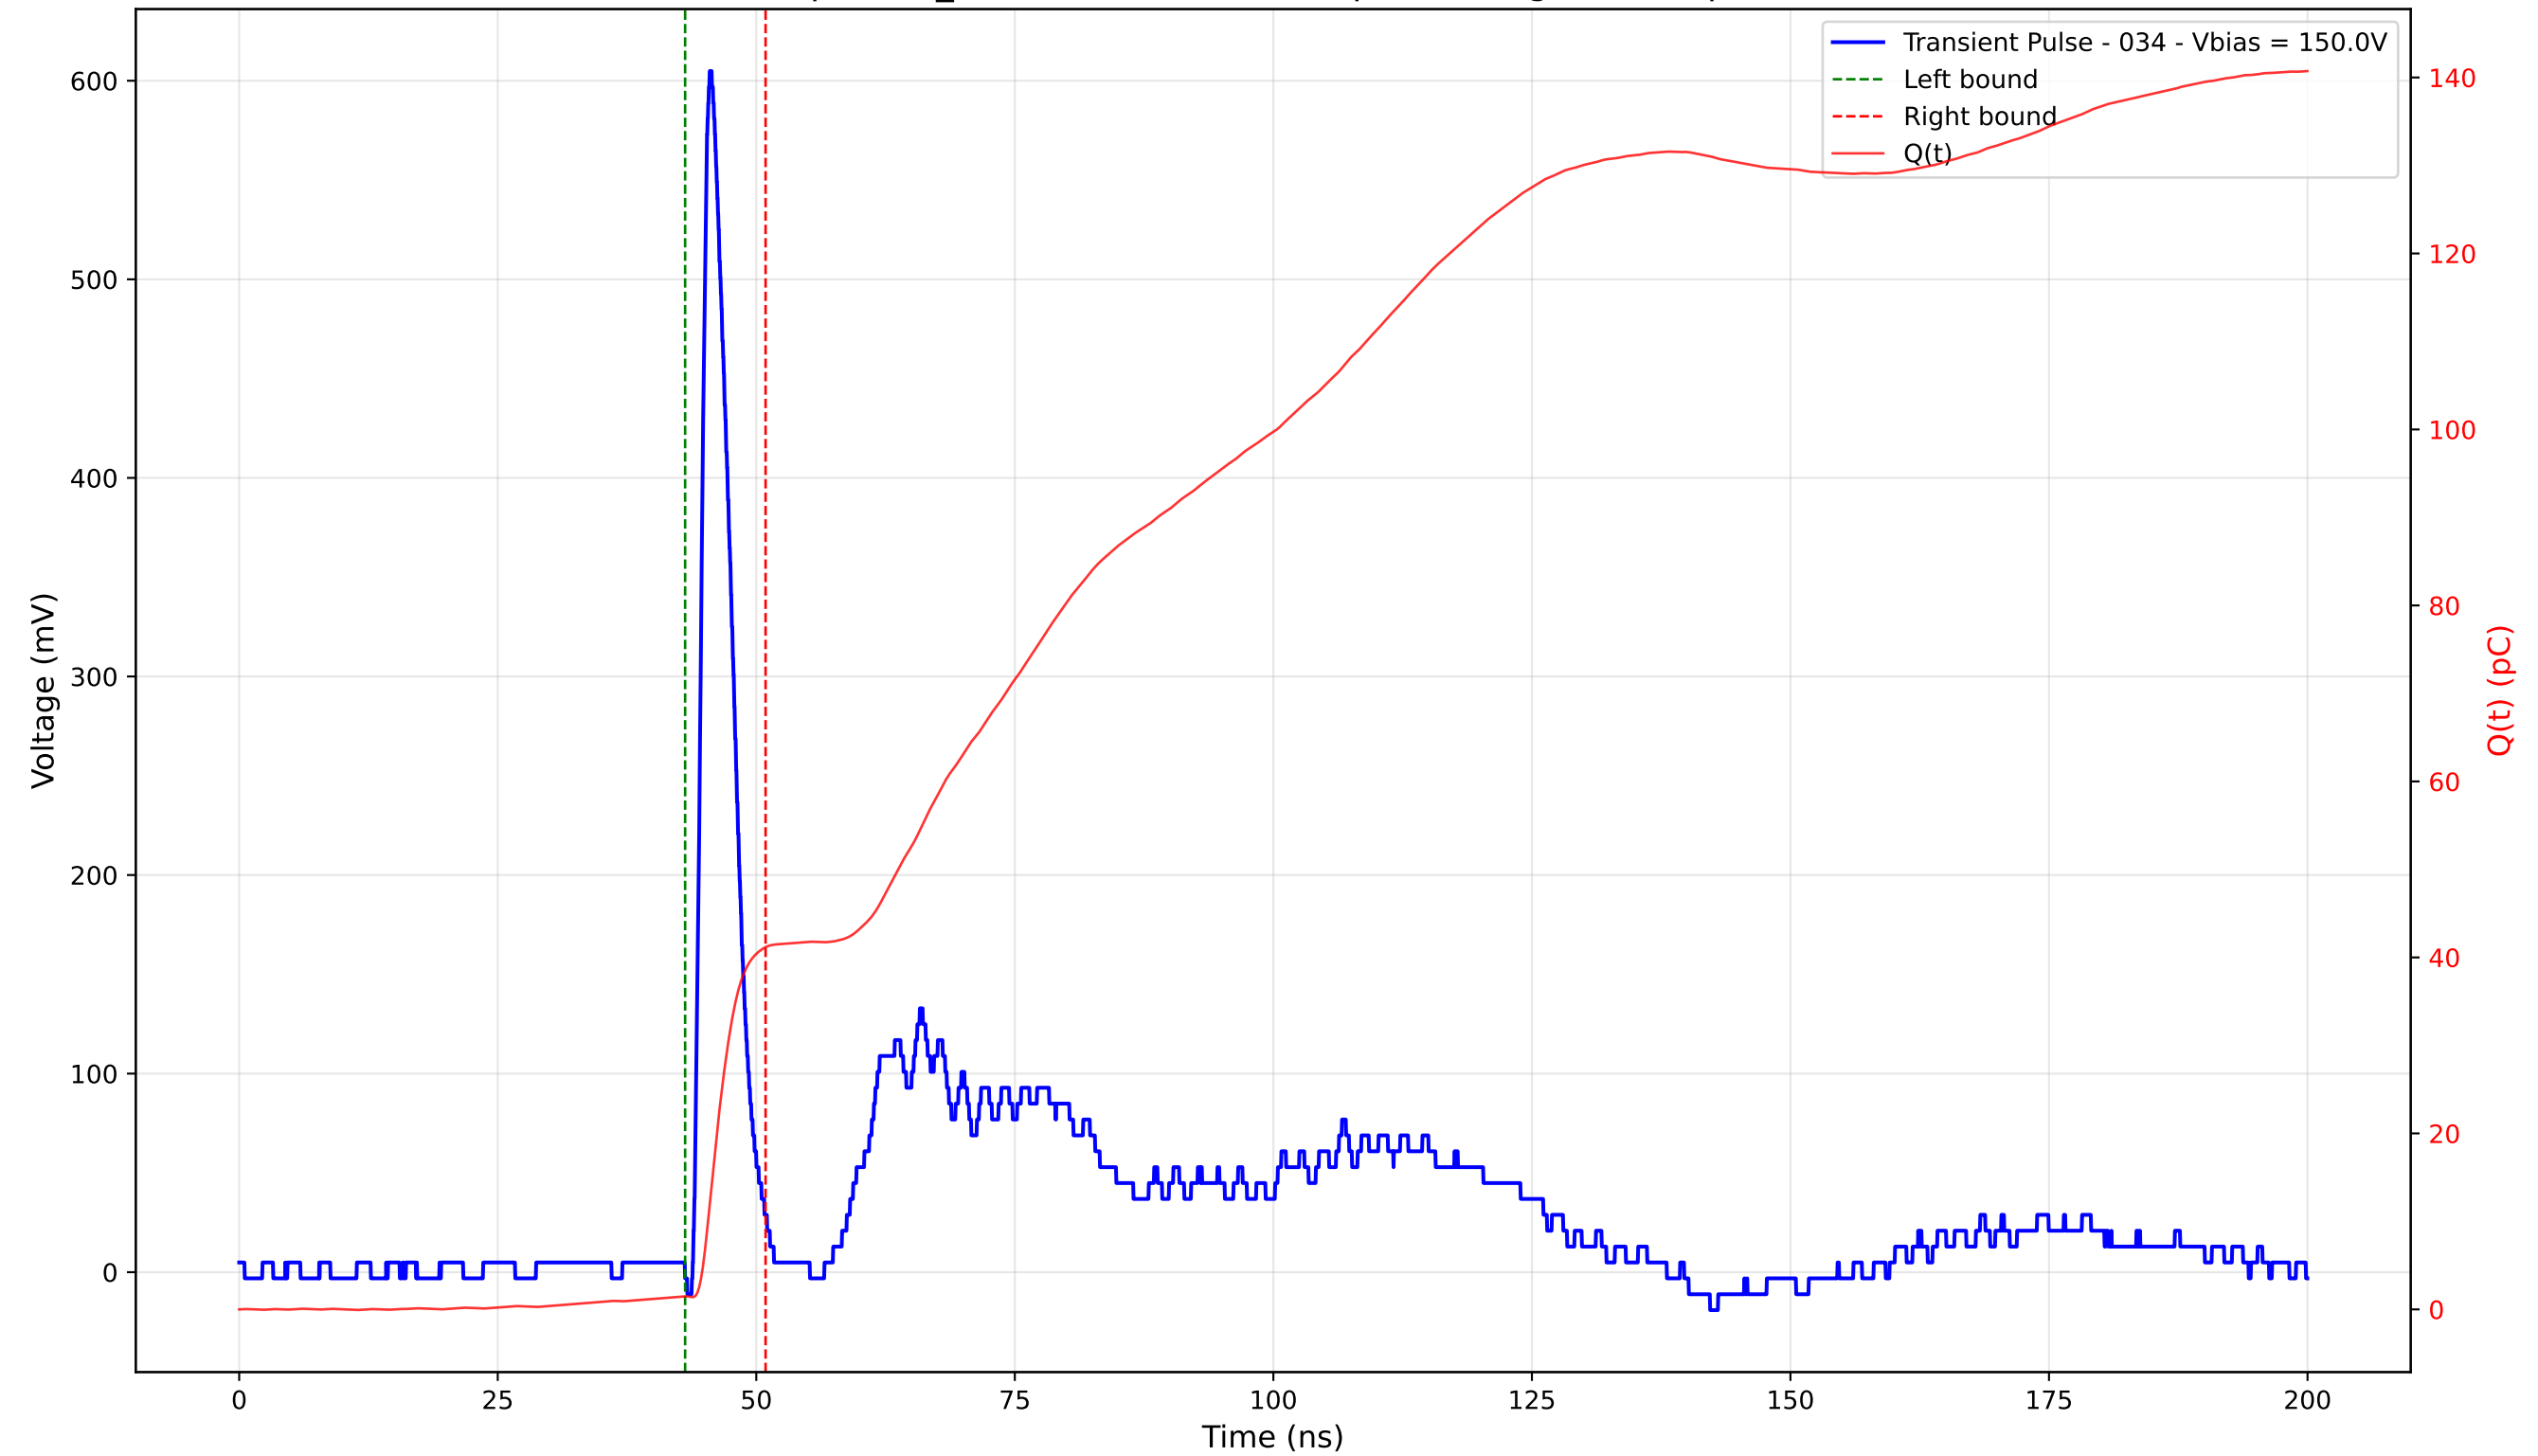


Transient Pulse - Sample: TD_4004 - Position: 290.0 μm - Charge: 36.95 pC - Rise Time: 1.02 ns

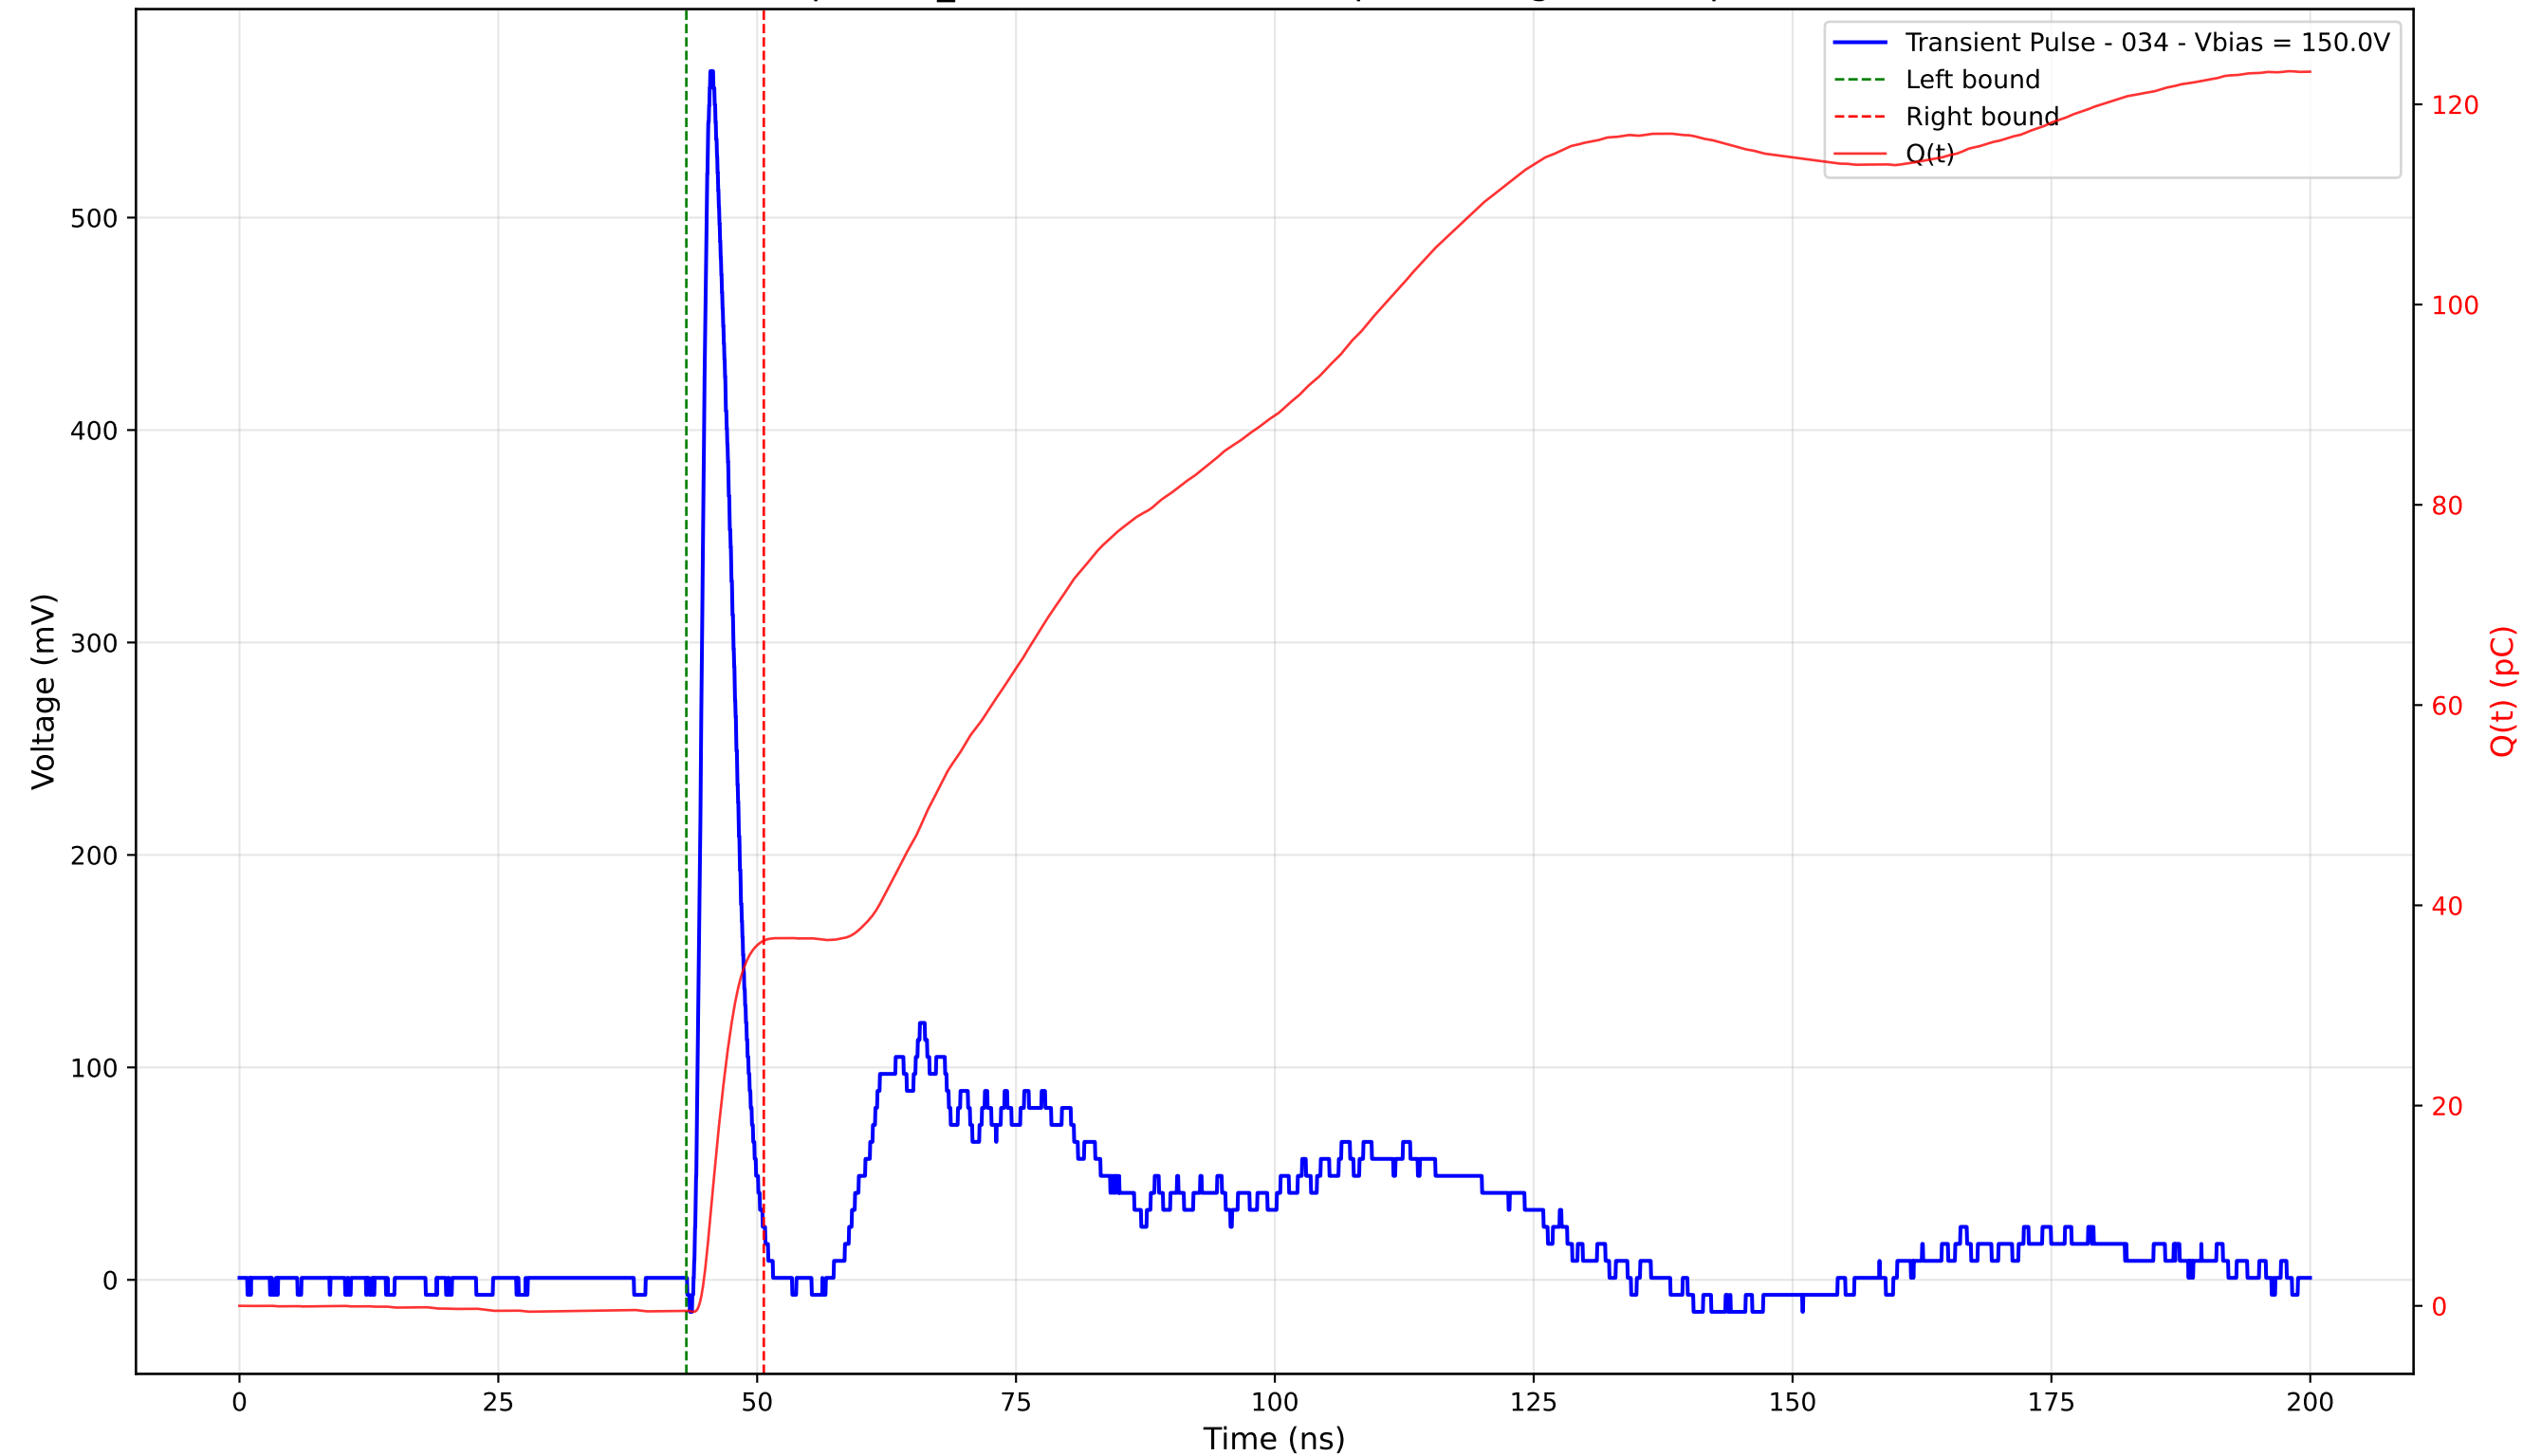


Transient Pulse - Sample: TD_4004 - Position: 295.0 μm - Charge: 35.44 pC - Rise Time: 1.07 ns

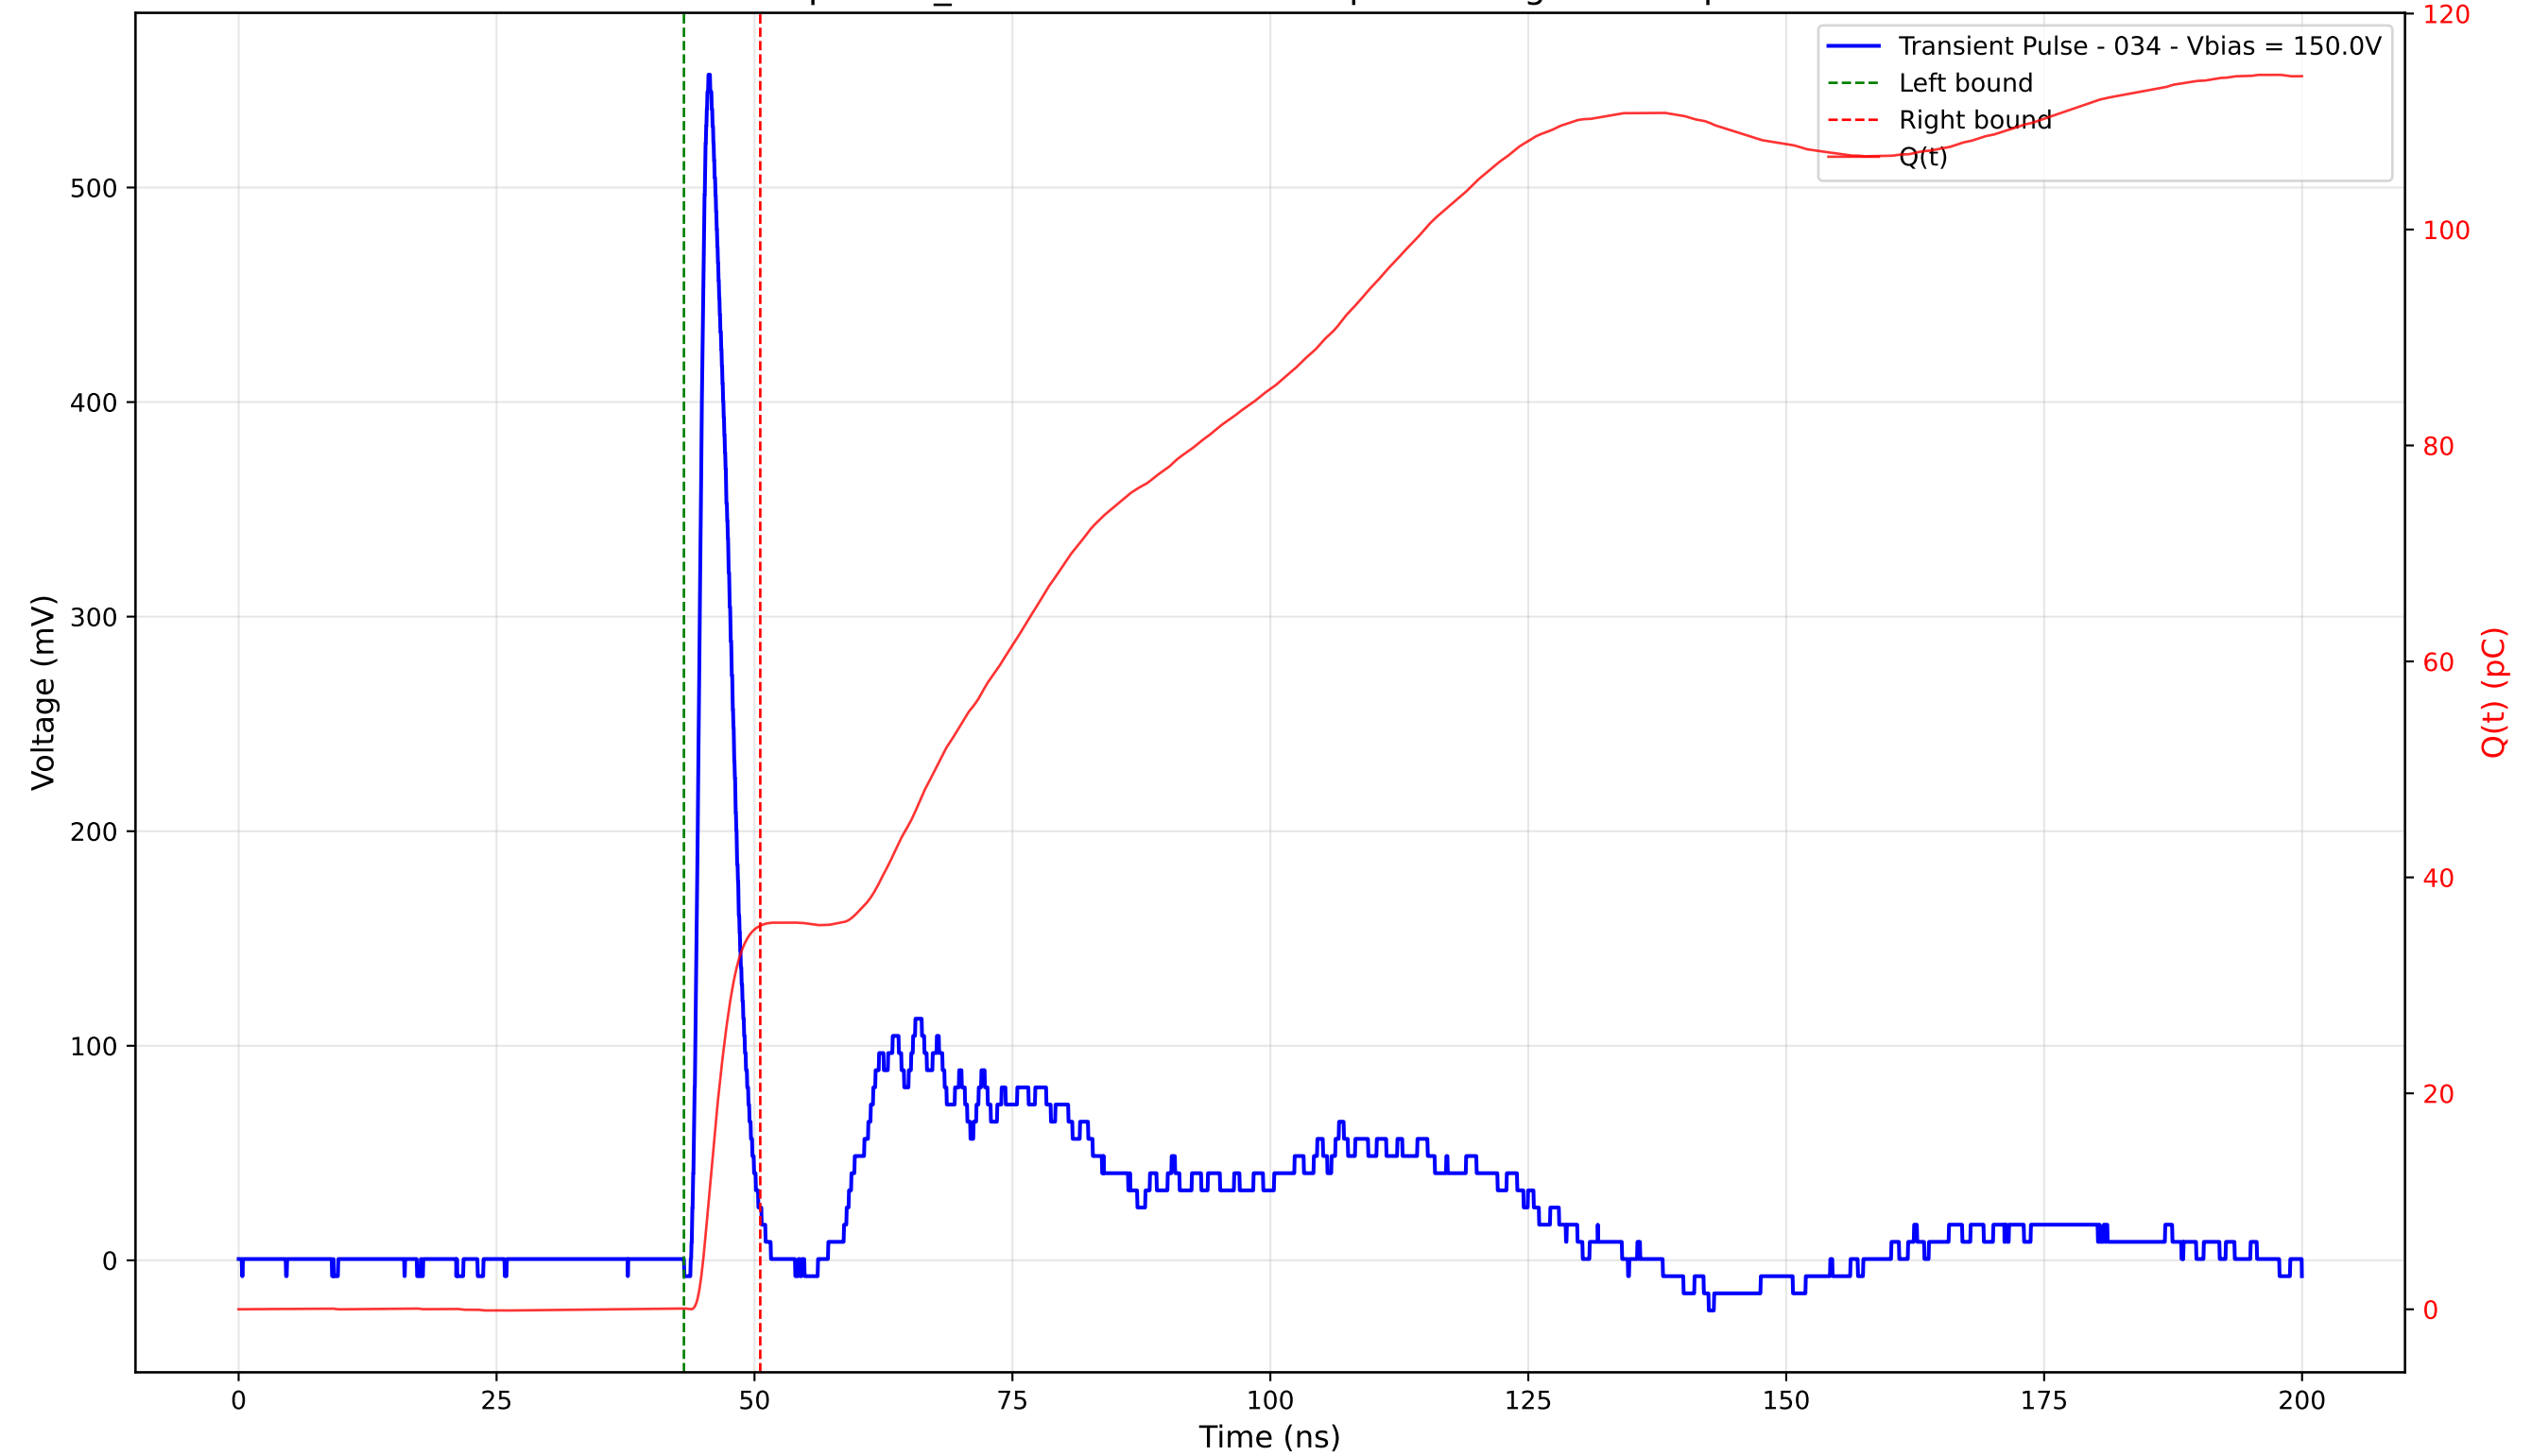


Transient Pulse - Sample: TD_4004 - Position: 300.0 μm - Charge: 36.00 pC - Rise Time: 1.07 ns

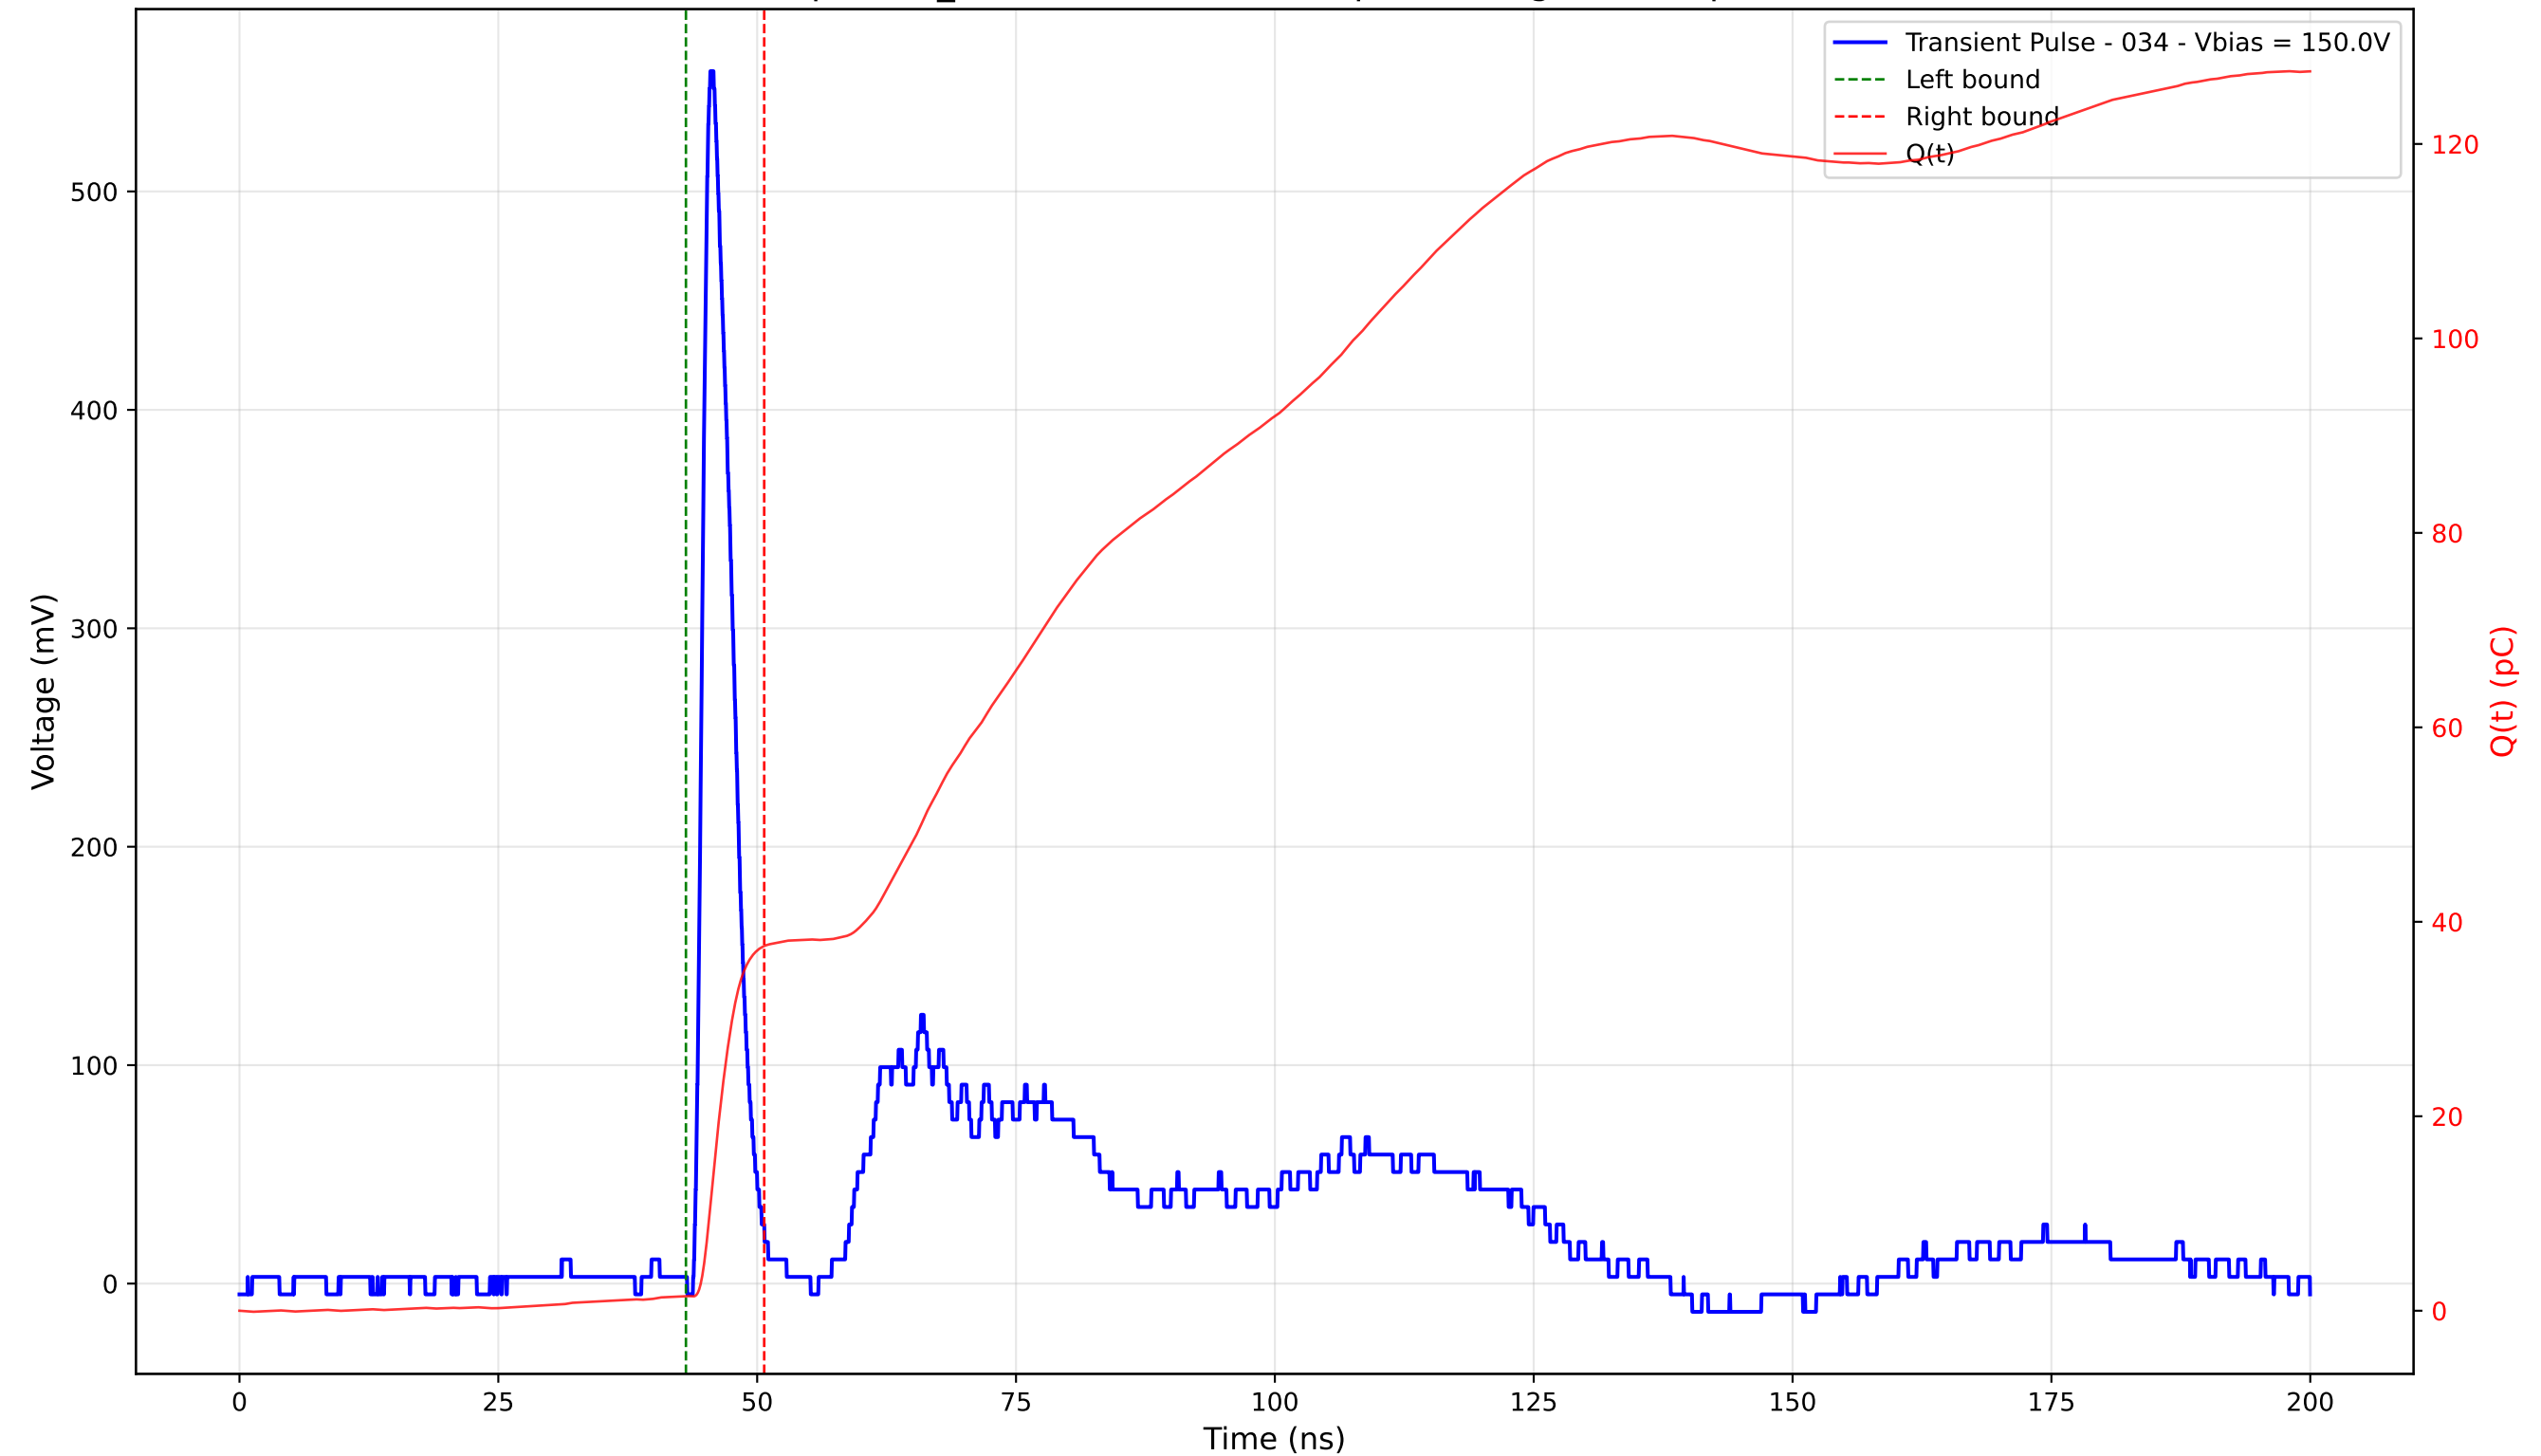


Transient Pulse - Sample: TD_4004 - Position: 305.0 μm - Charge: 34.80 pC - Rise Time: 1.05 ns

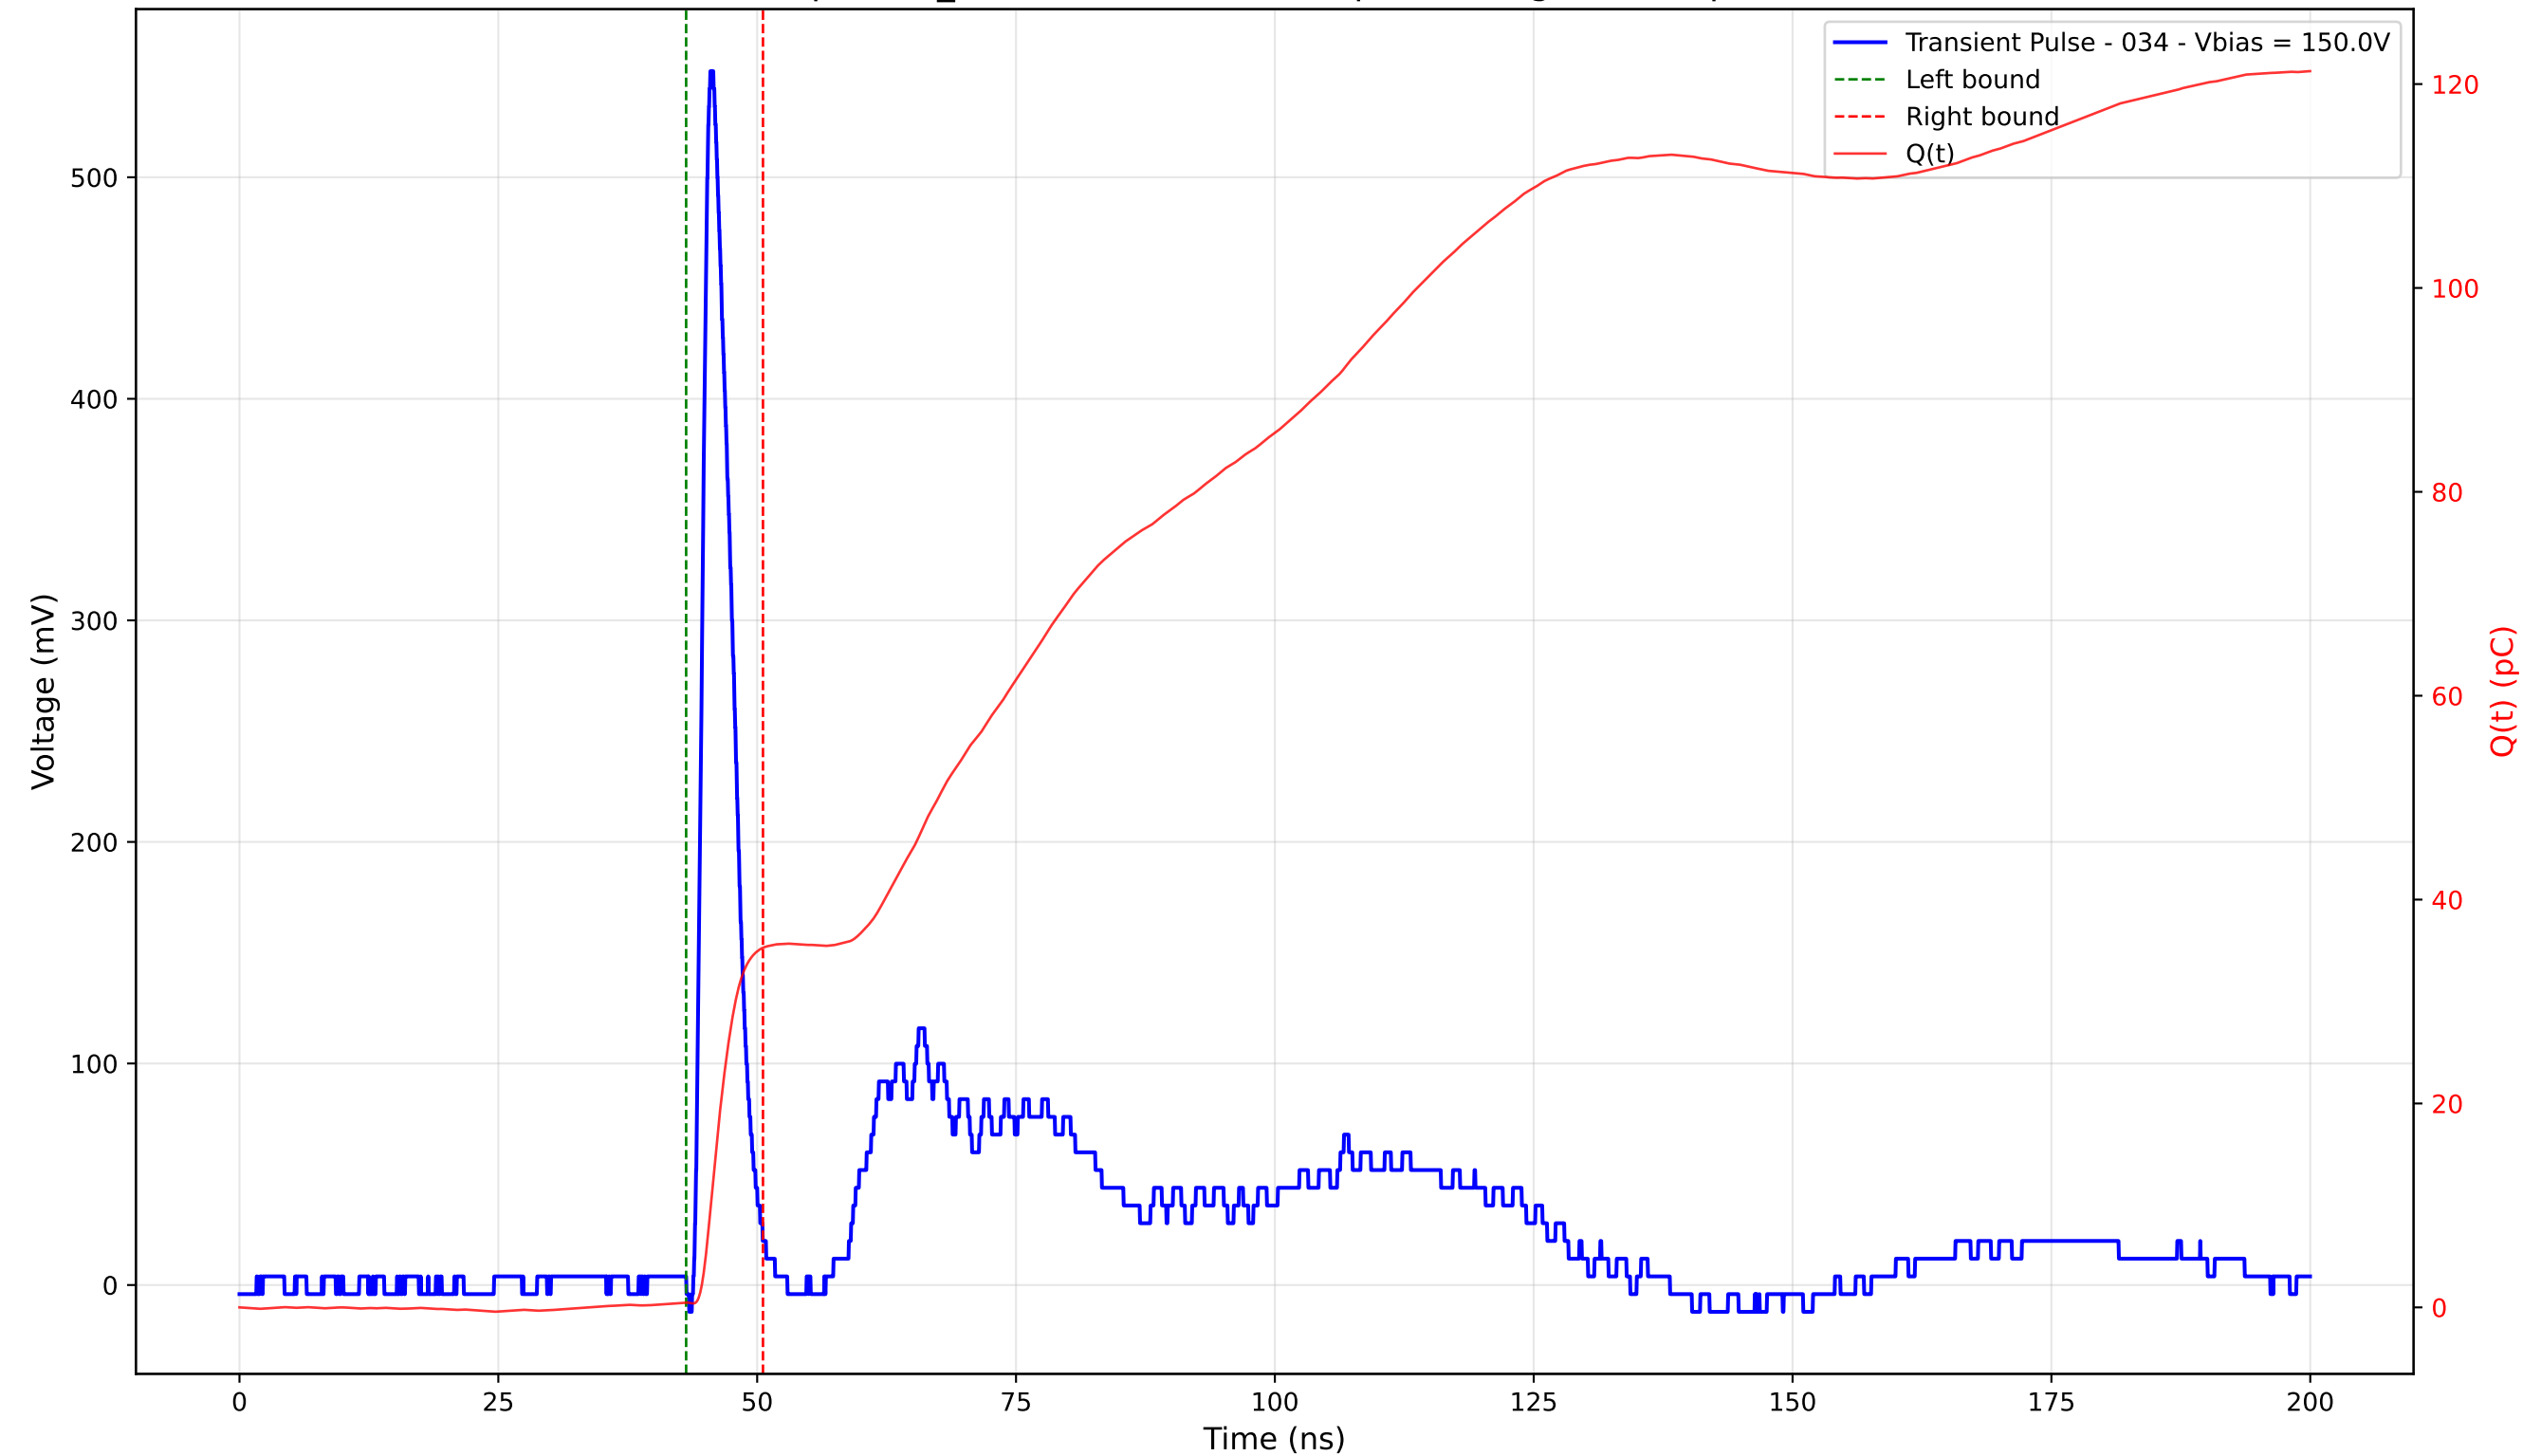


Transient Pulse - Sample: TD_4004 - Position: 310.0 μm - Charge: 32.32 pC - Rise Time: 1.05 ns

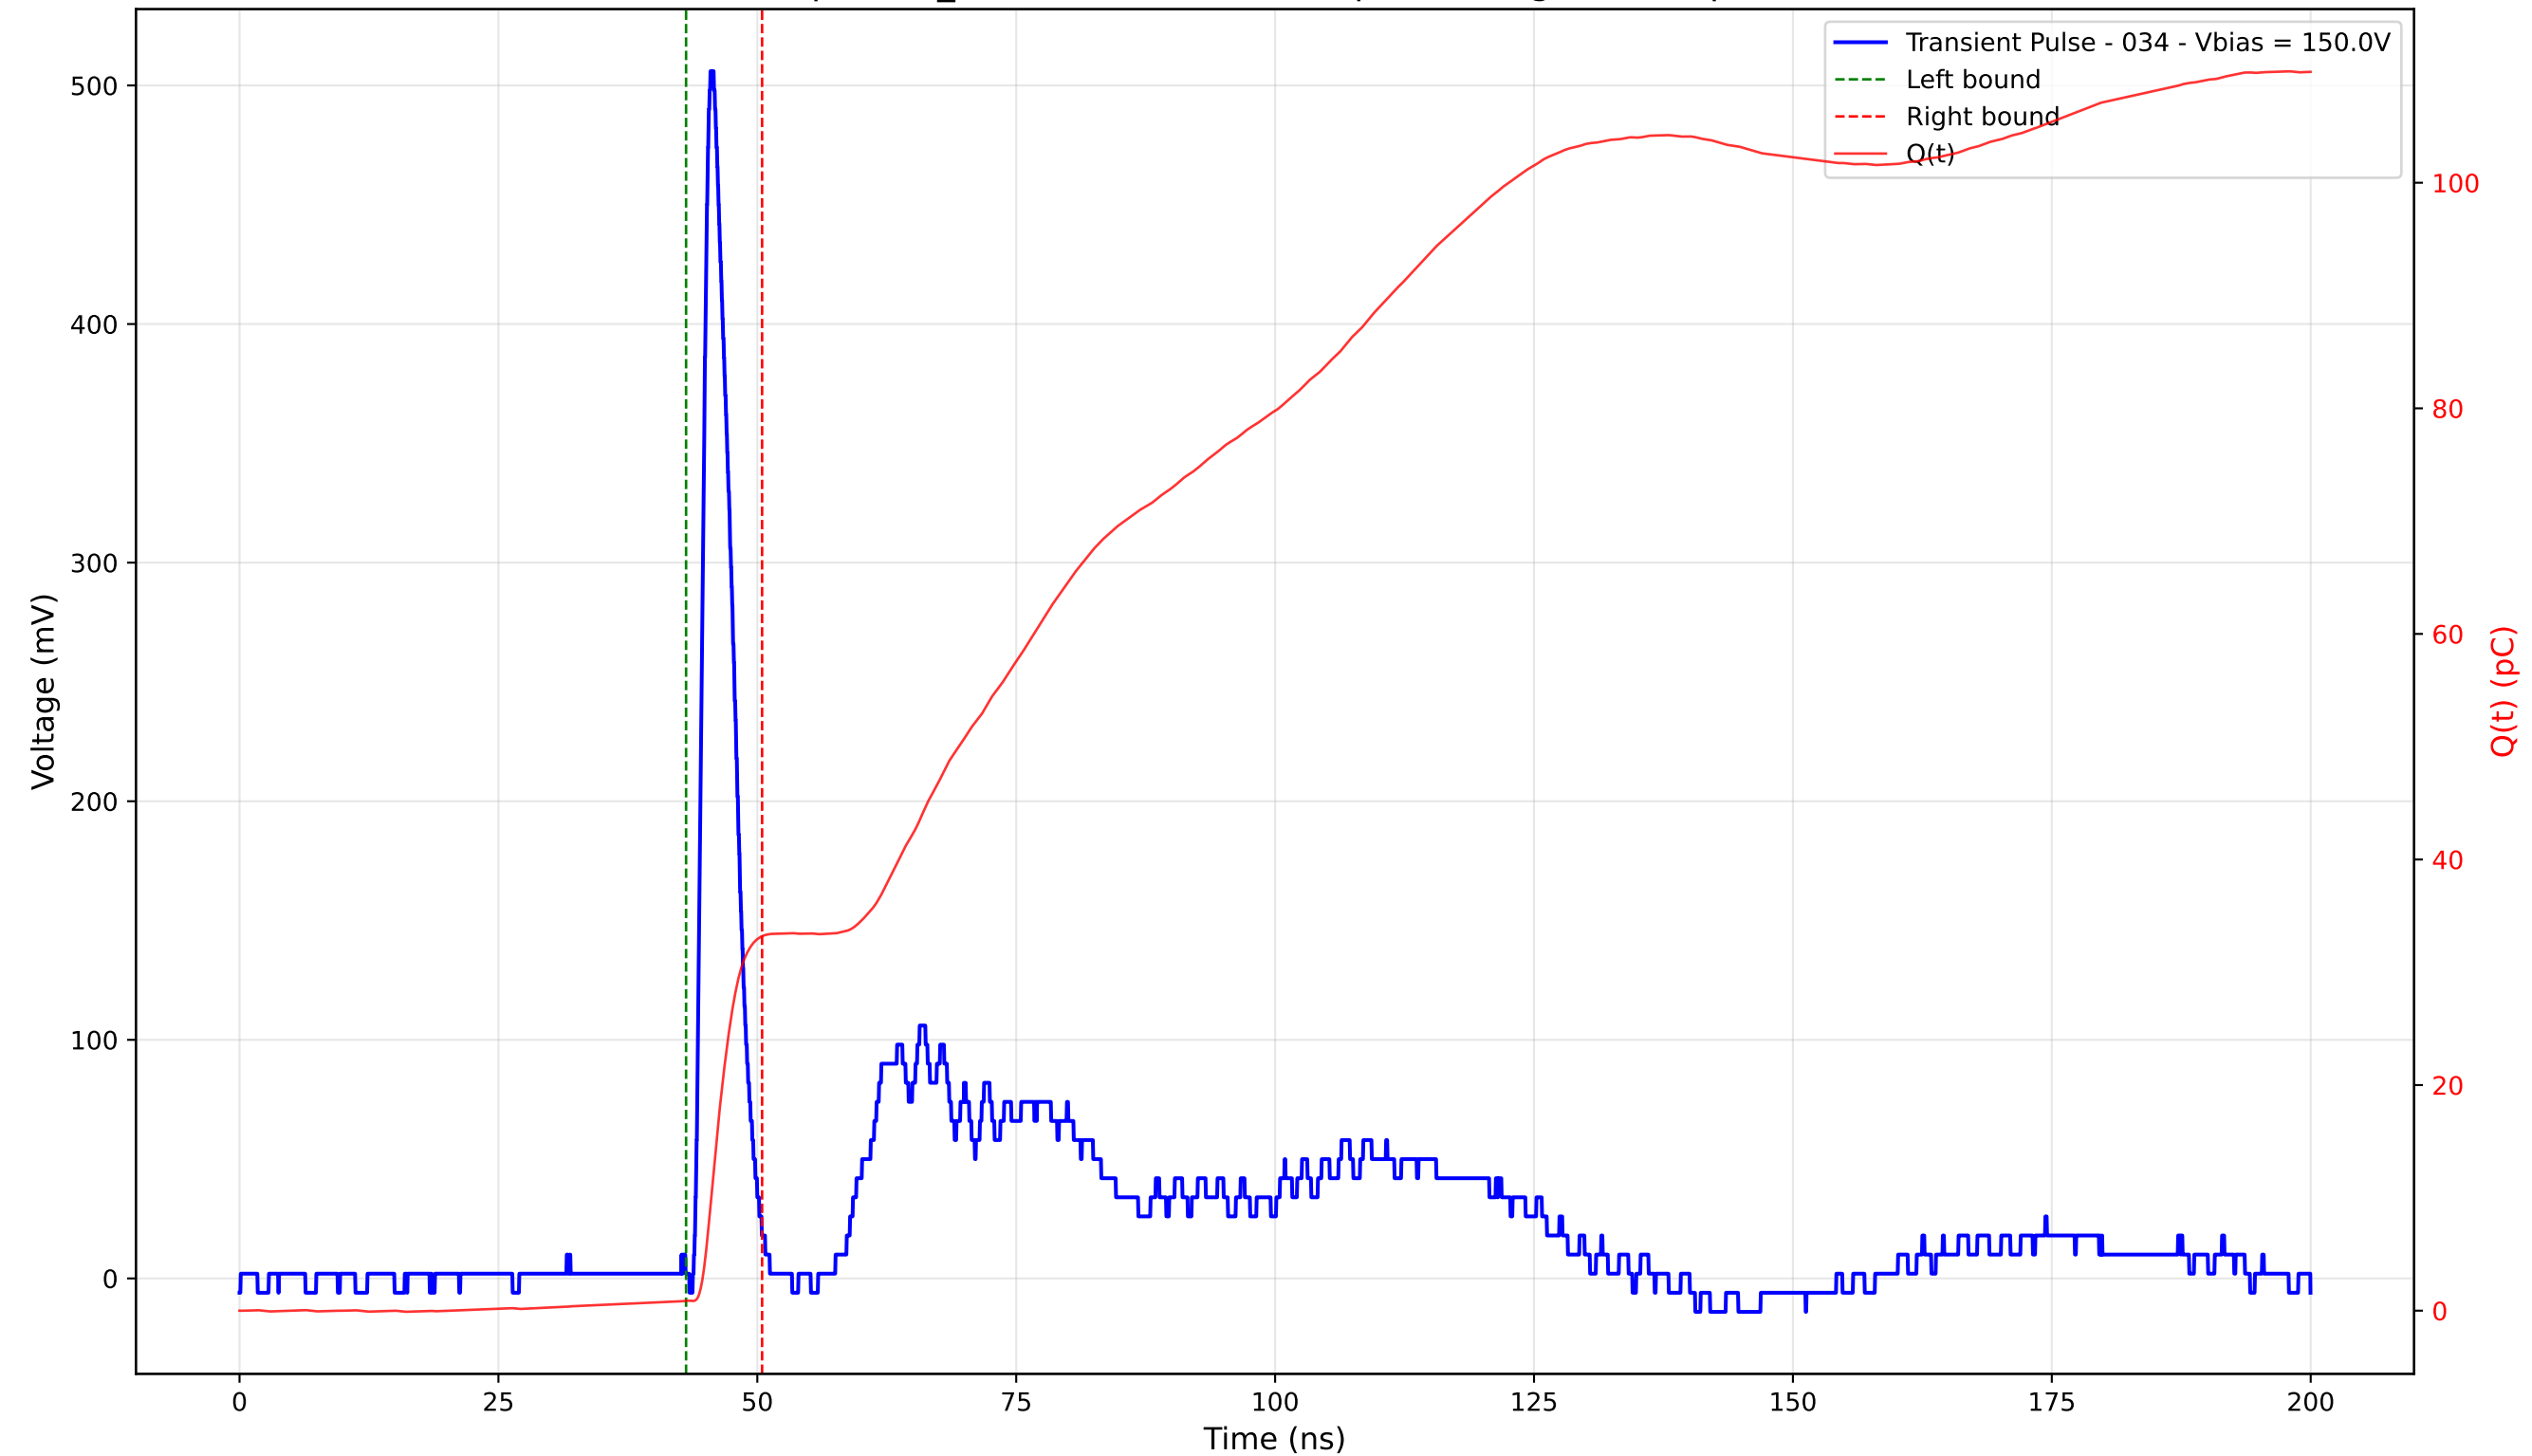


Transient Pulse - Sample: TD_4004 - Position: 315.0 μm - Charge: 30.00 pC - Rise Time: 1.05 ns

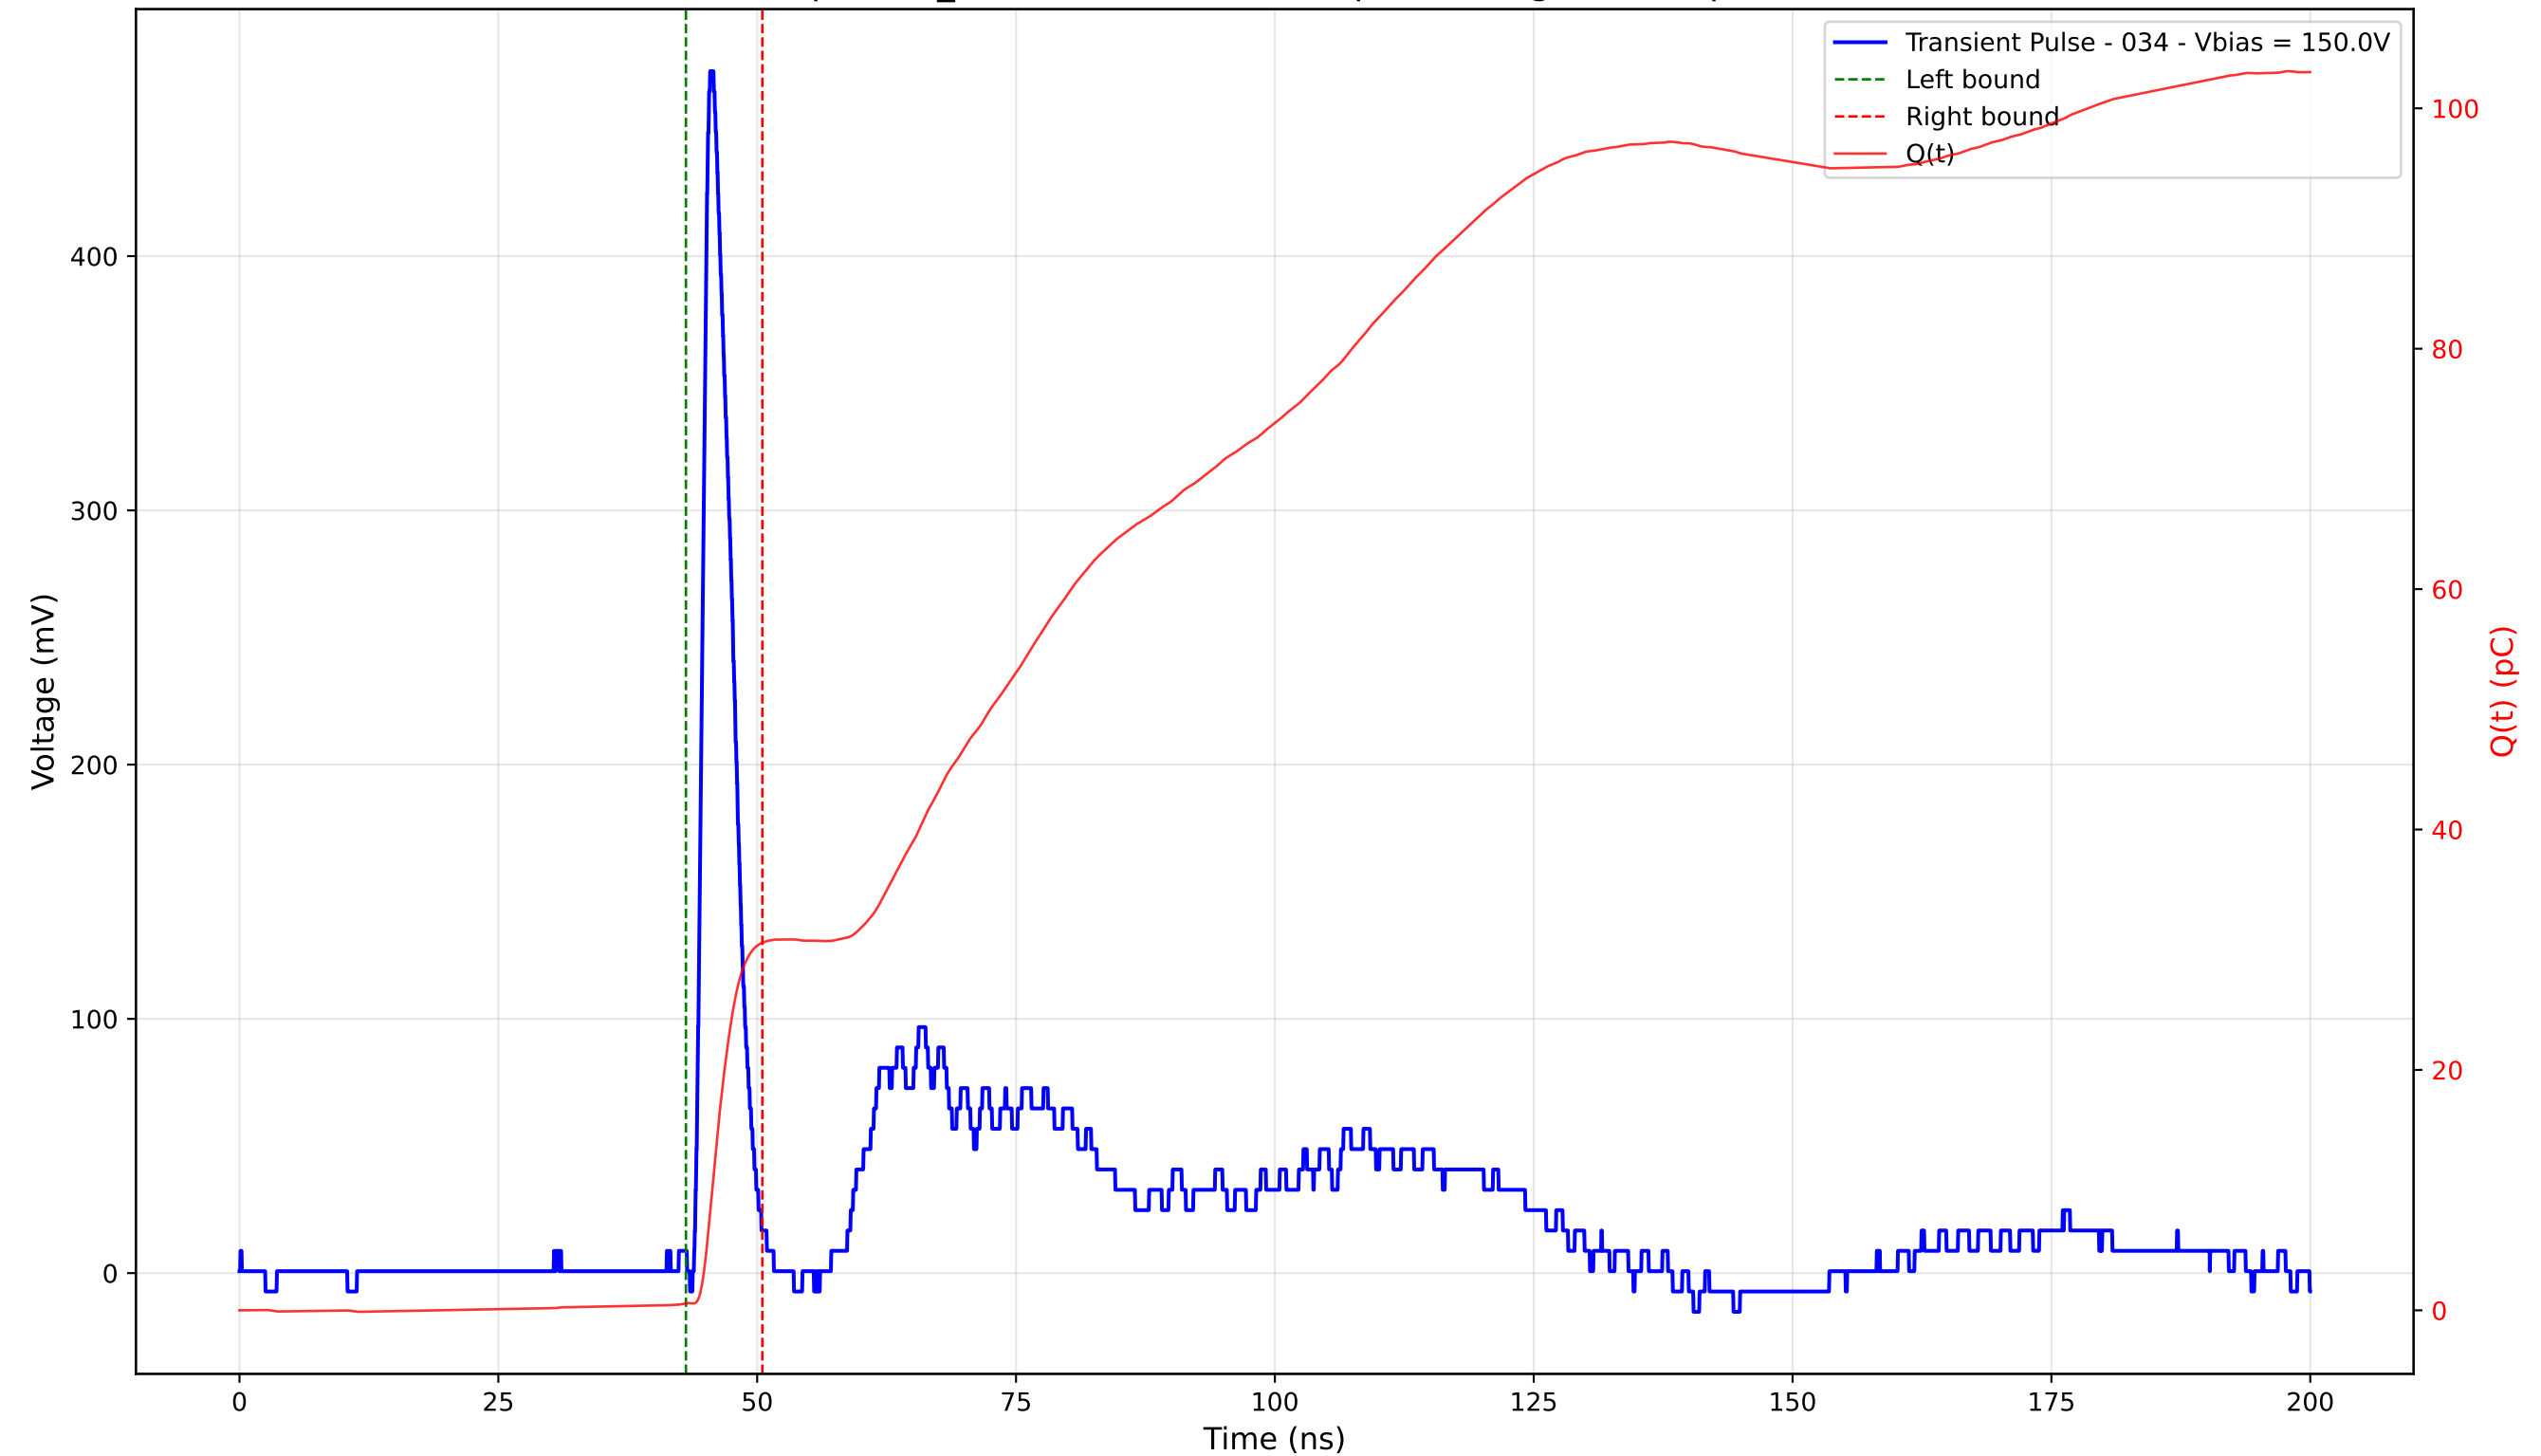


Transient Pulse - Sample: TD_4004 - Position: 320.0 μm - Charge: 28.99 pC - Rise Time: 1.05 ns

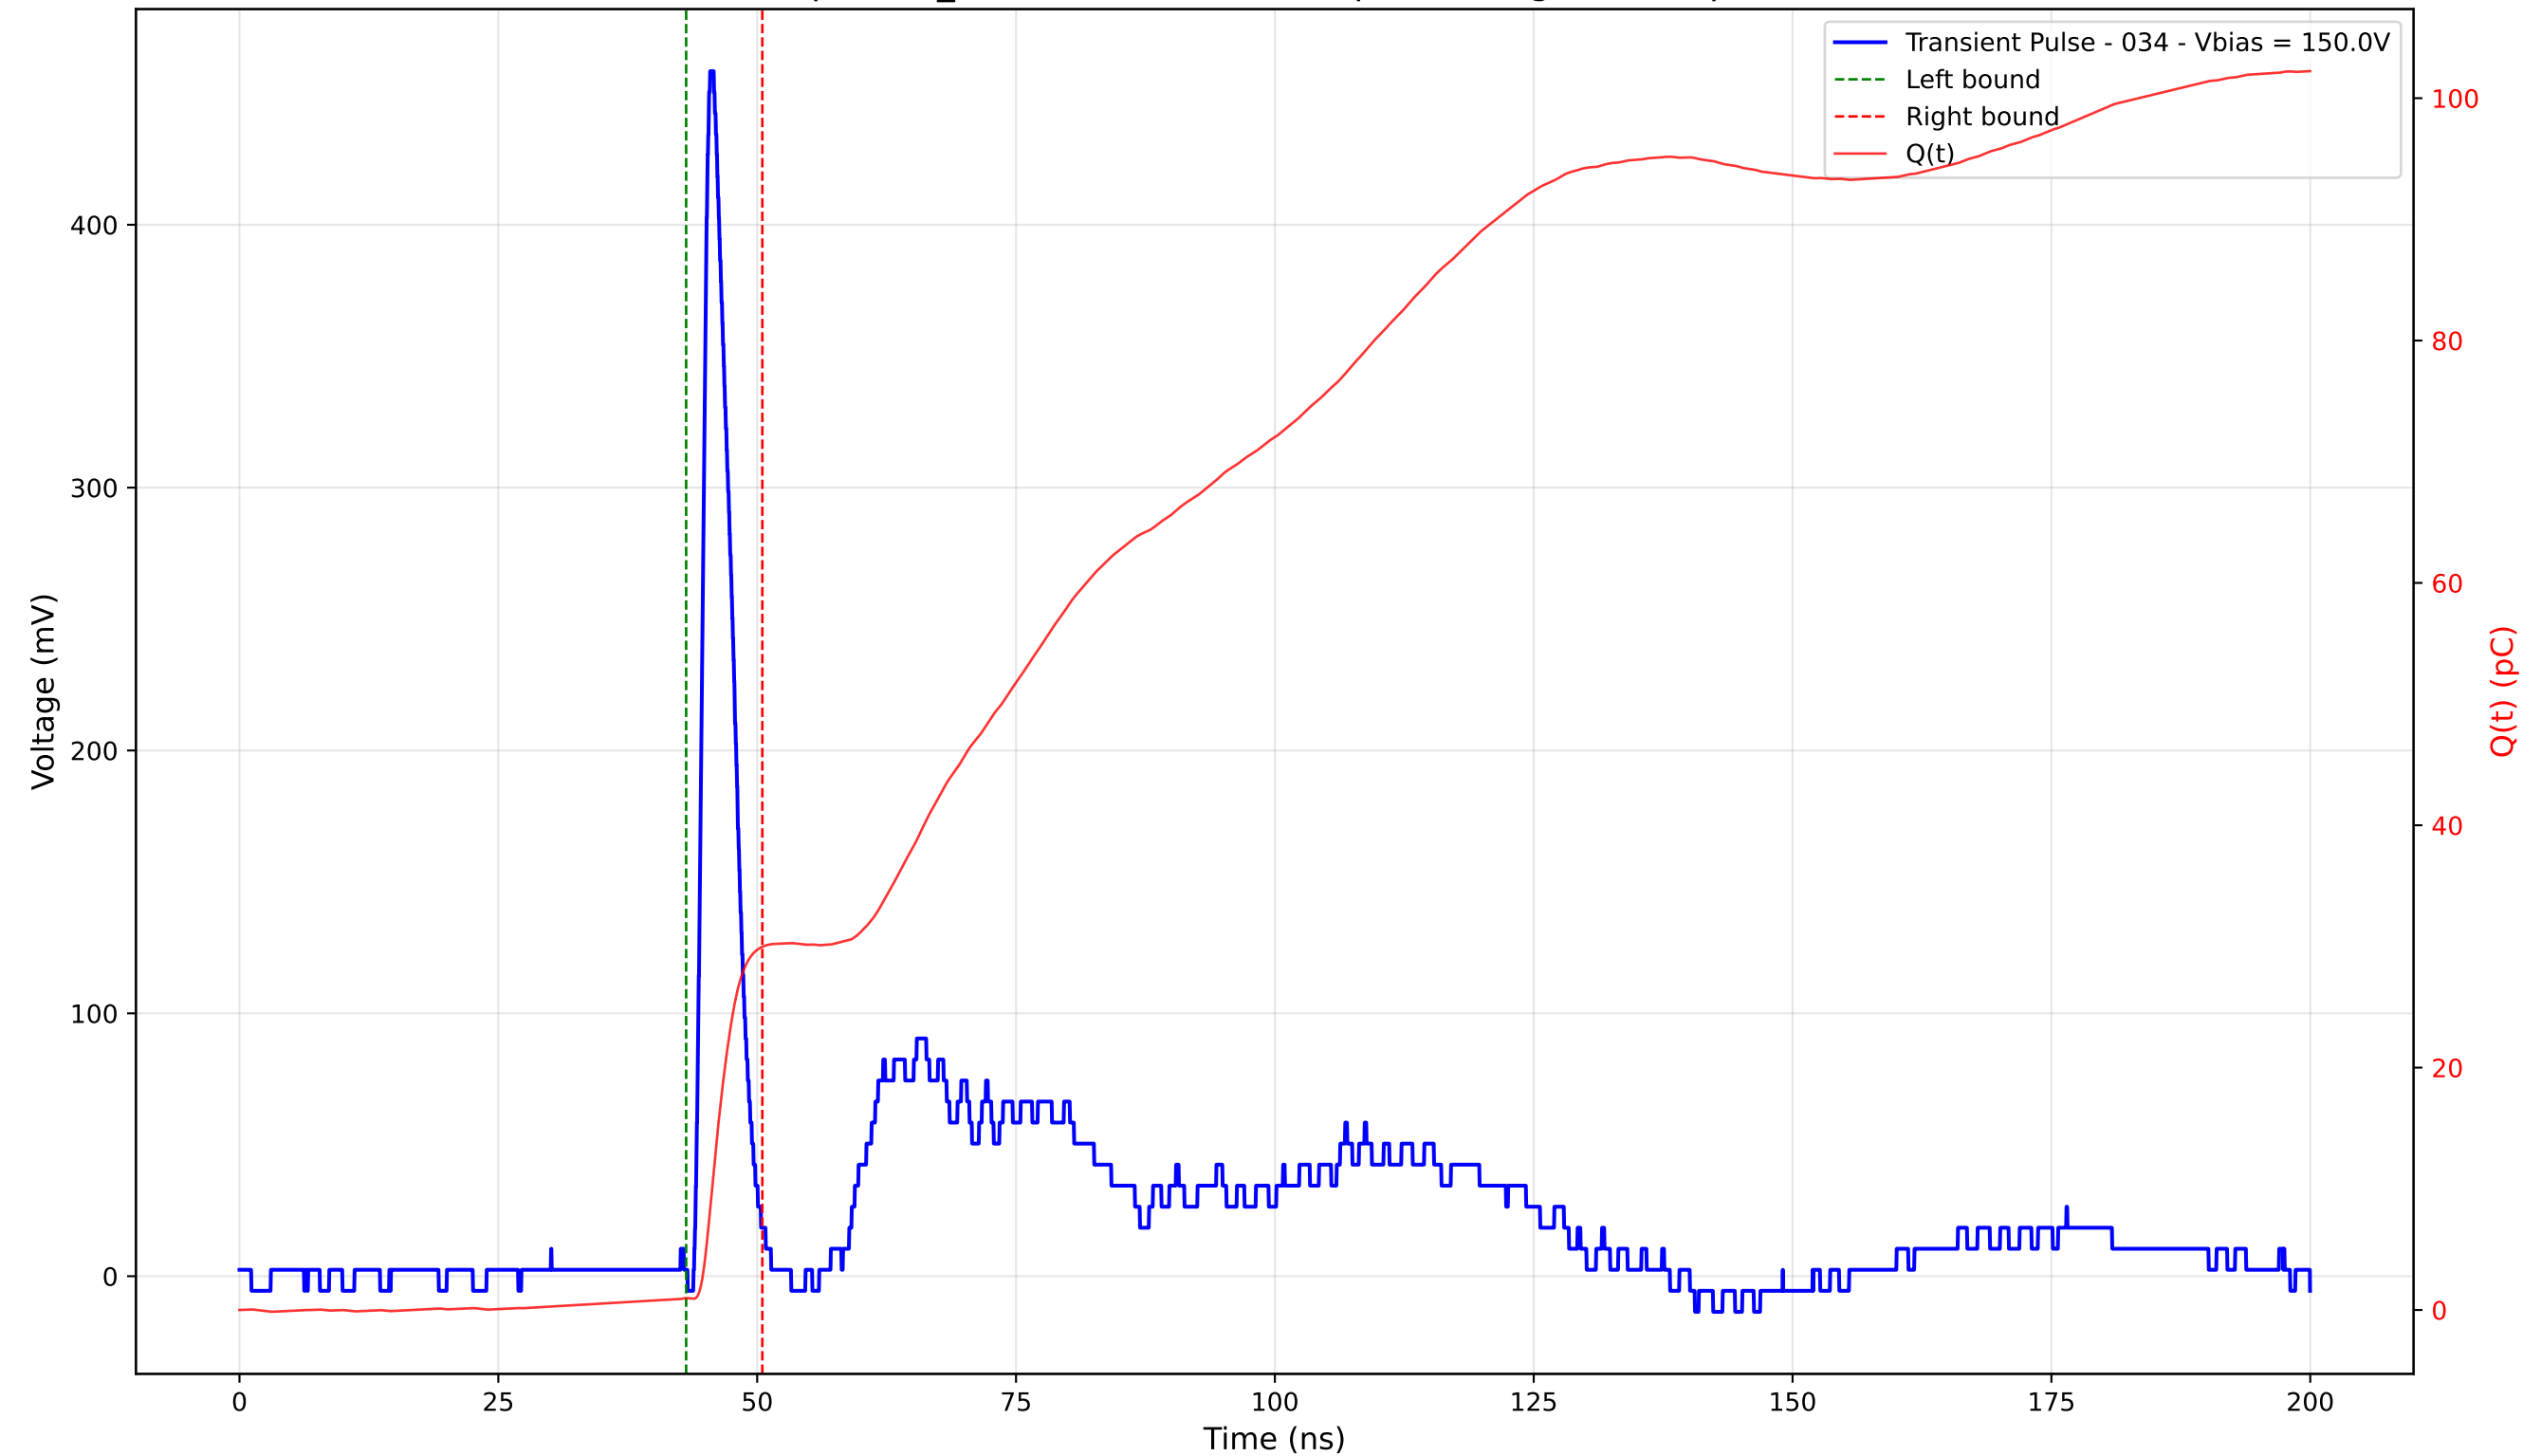


Transient Pulse - Sample: TD_4004 - Position: 325.0 μm - Charge: 28.07 pC - Rise Time: 1.06 ns

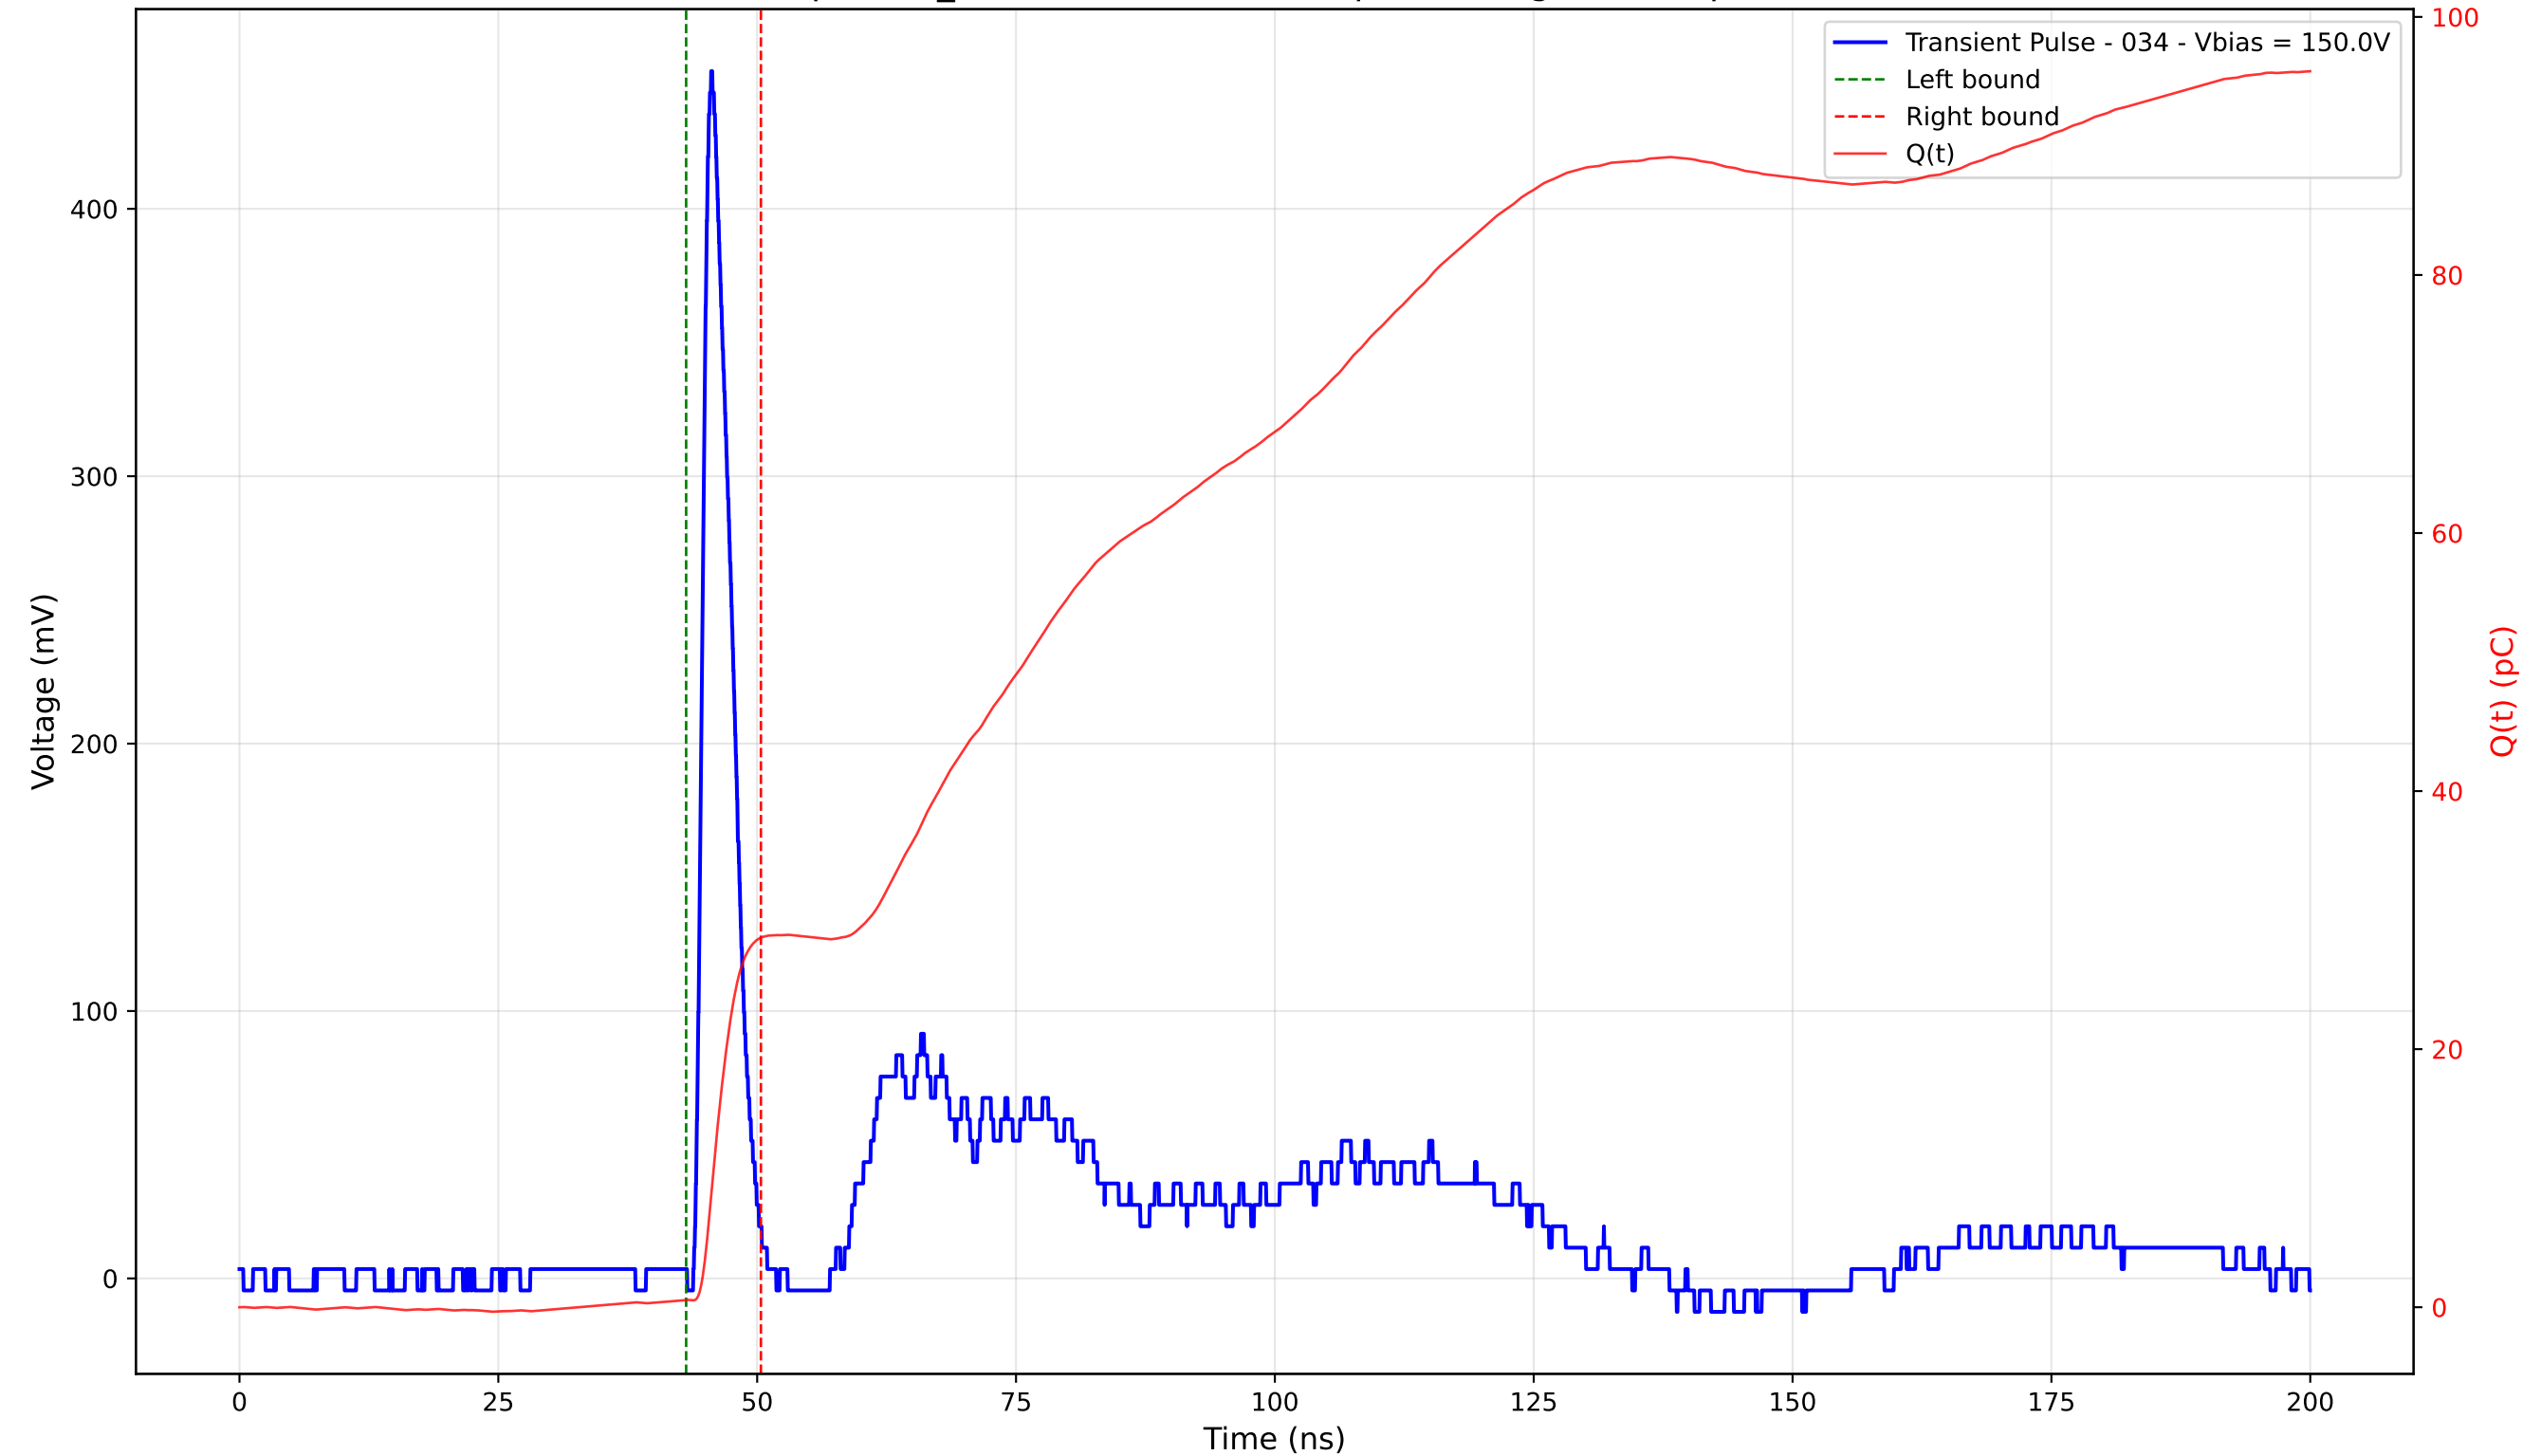


Transient Pulse - Sample: TD_4004 - Position: 330.0 μm - Charge: 25.28 pC - Rise Time: 1.04 ns

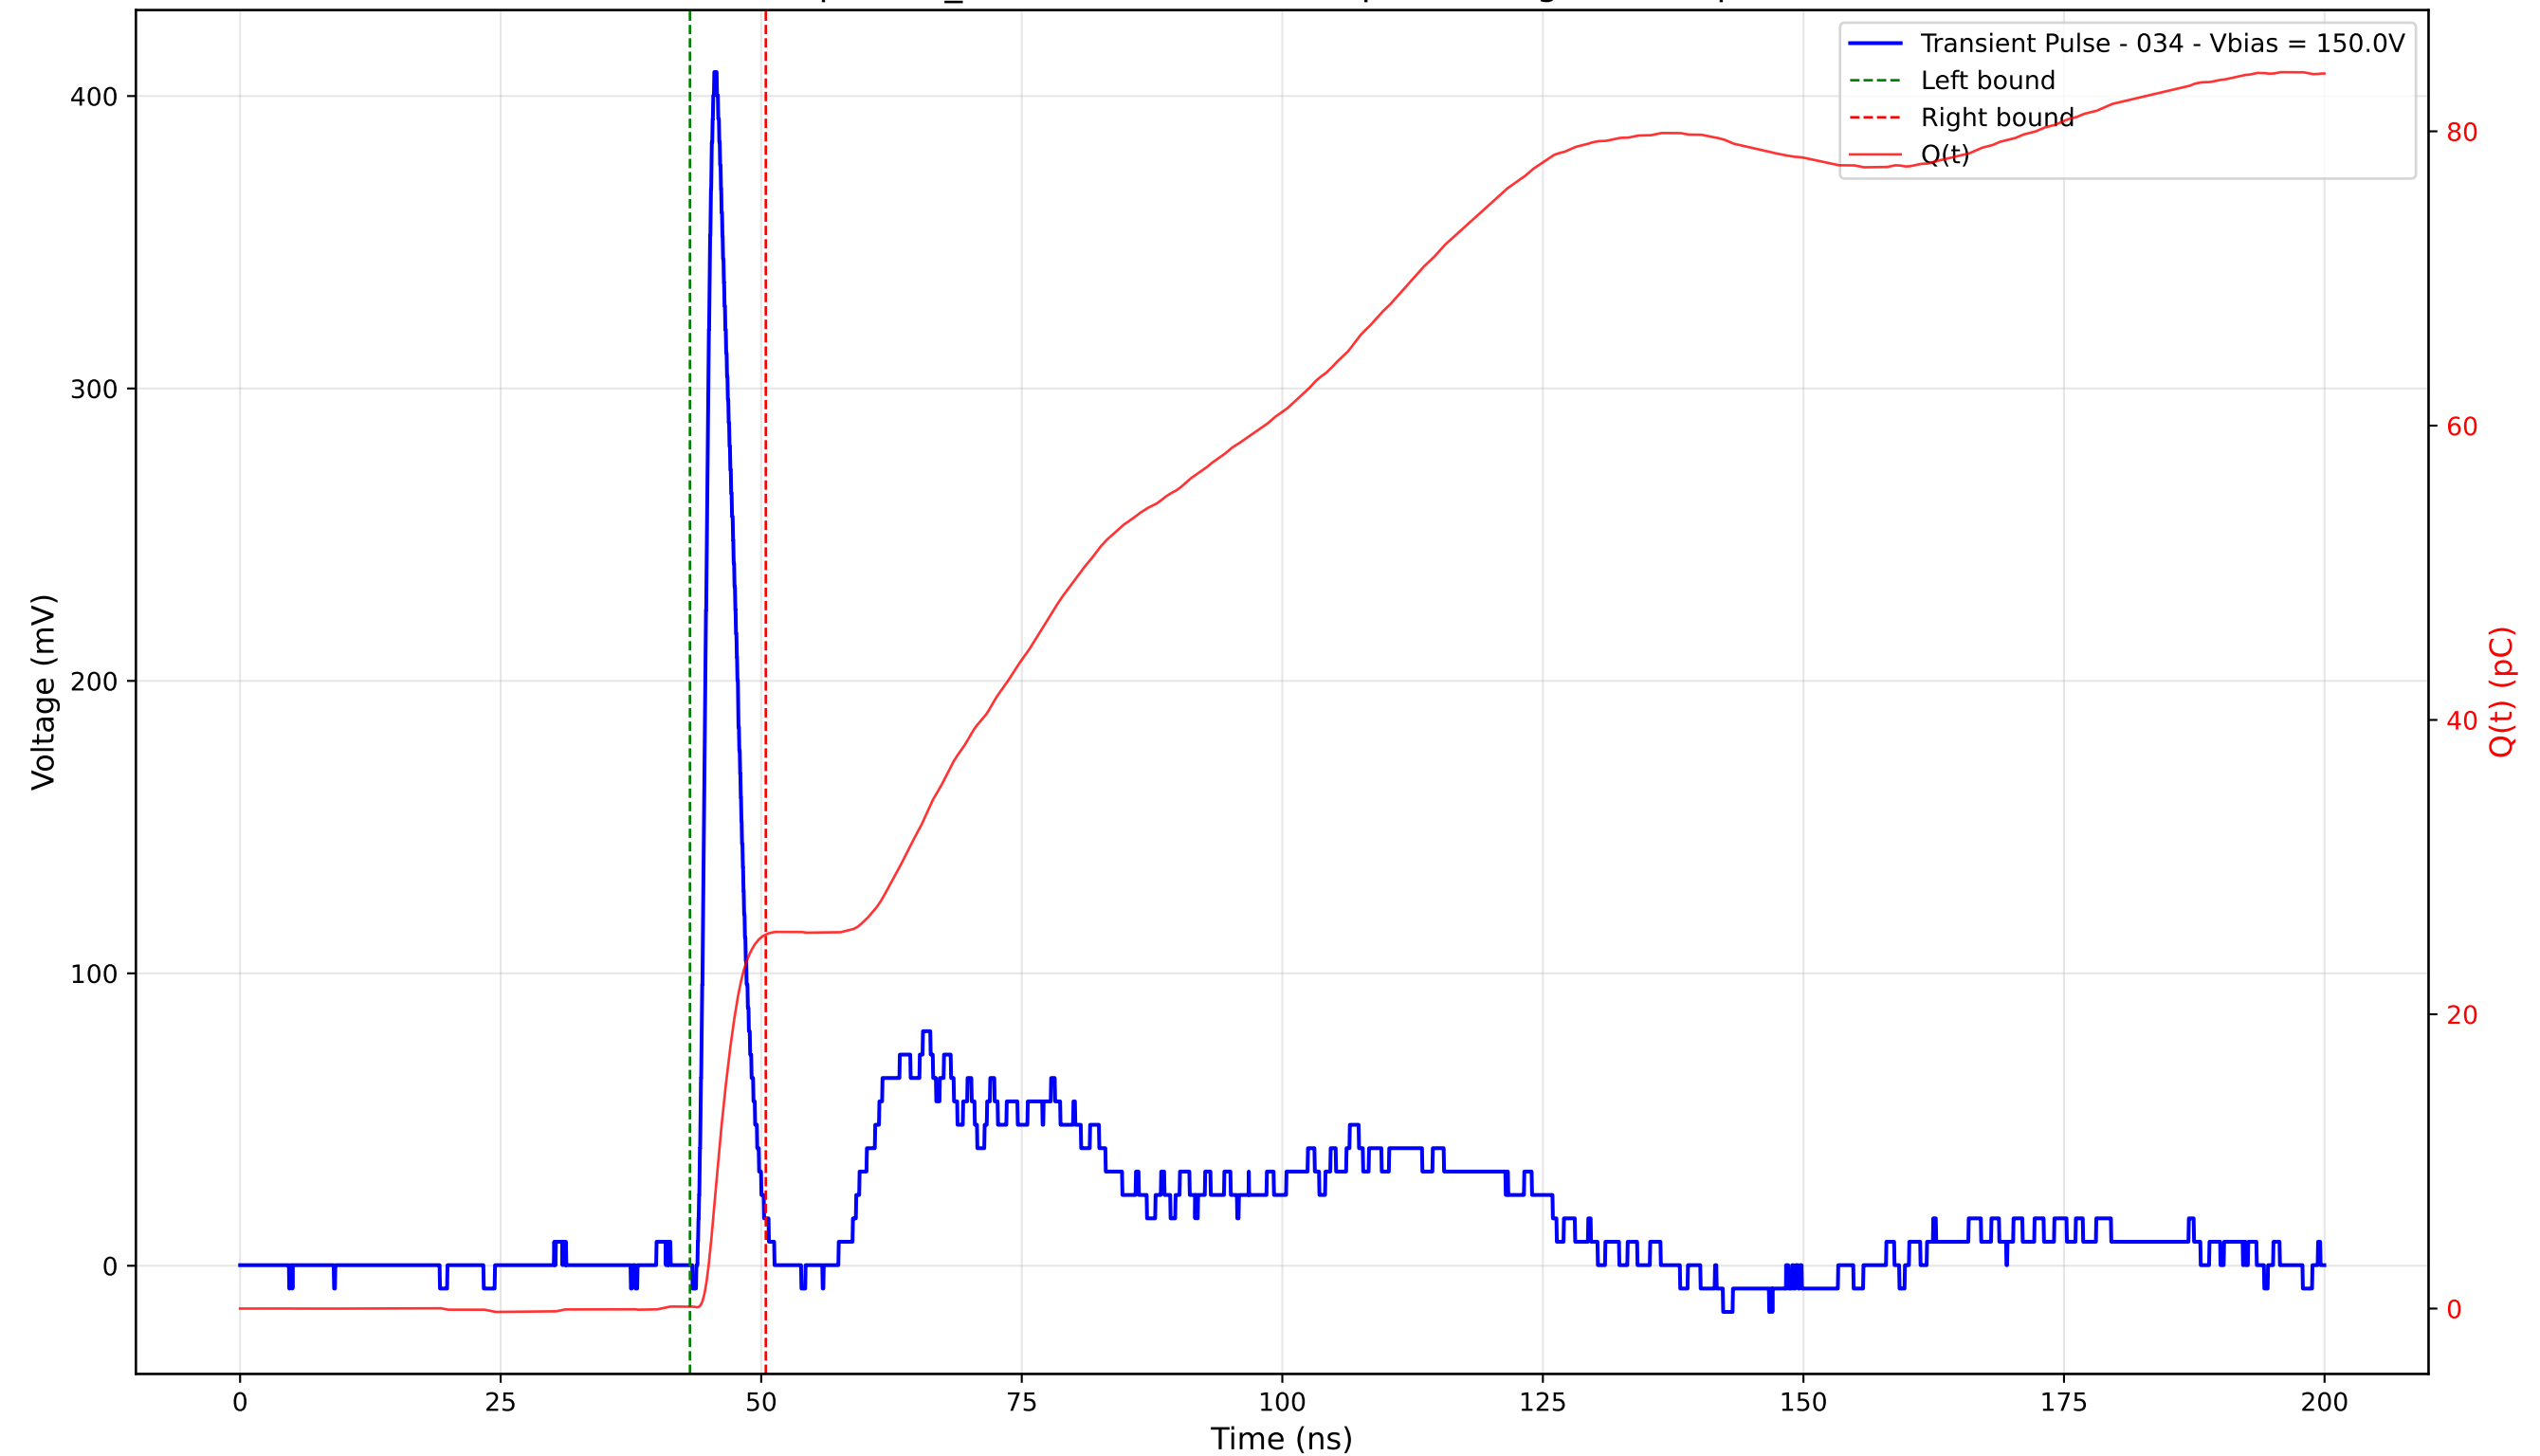


Transient Pulse - Sample: TD_4004 - Position: 335.0 μm - Charge: 22.48 pC - Rise Time: 1.07 ns

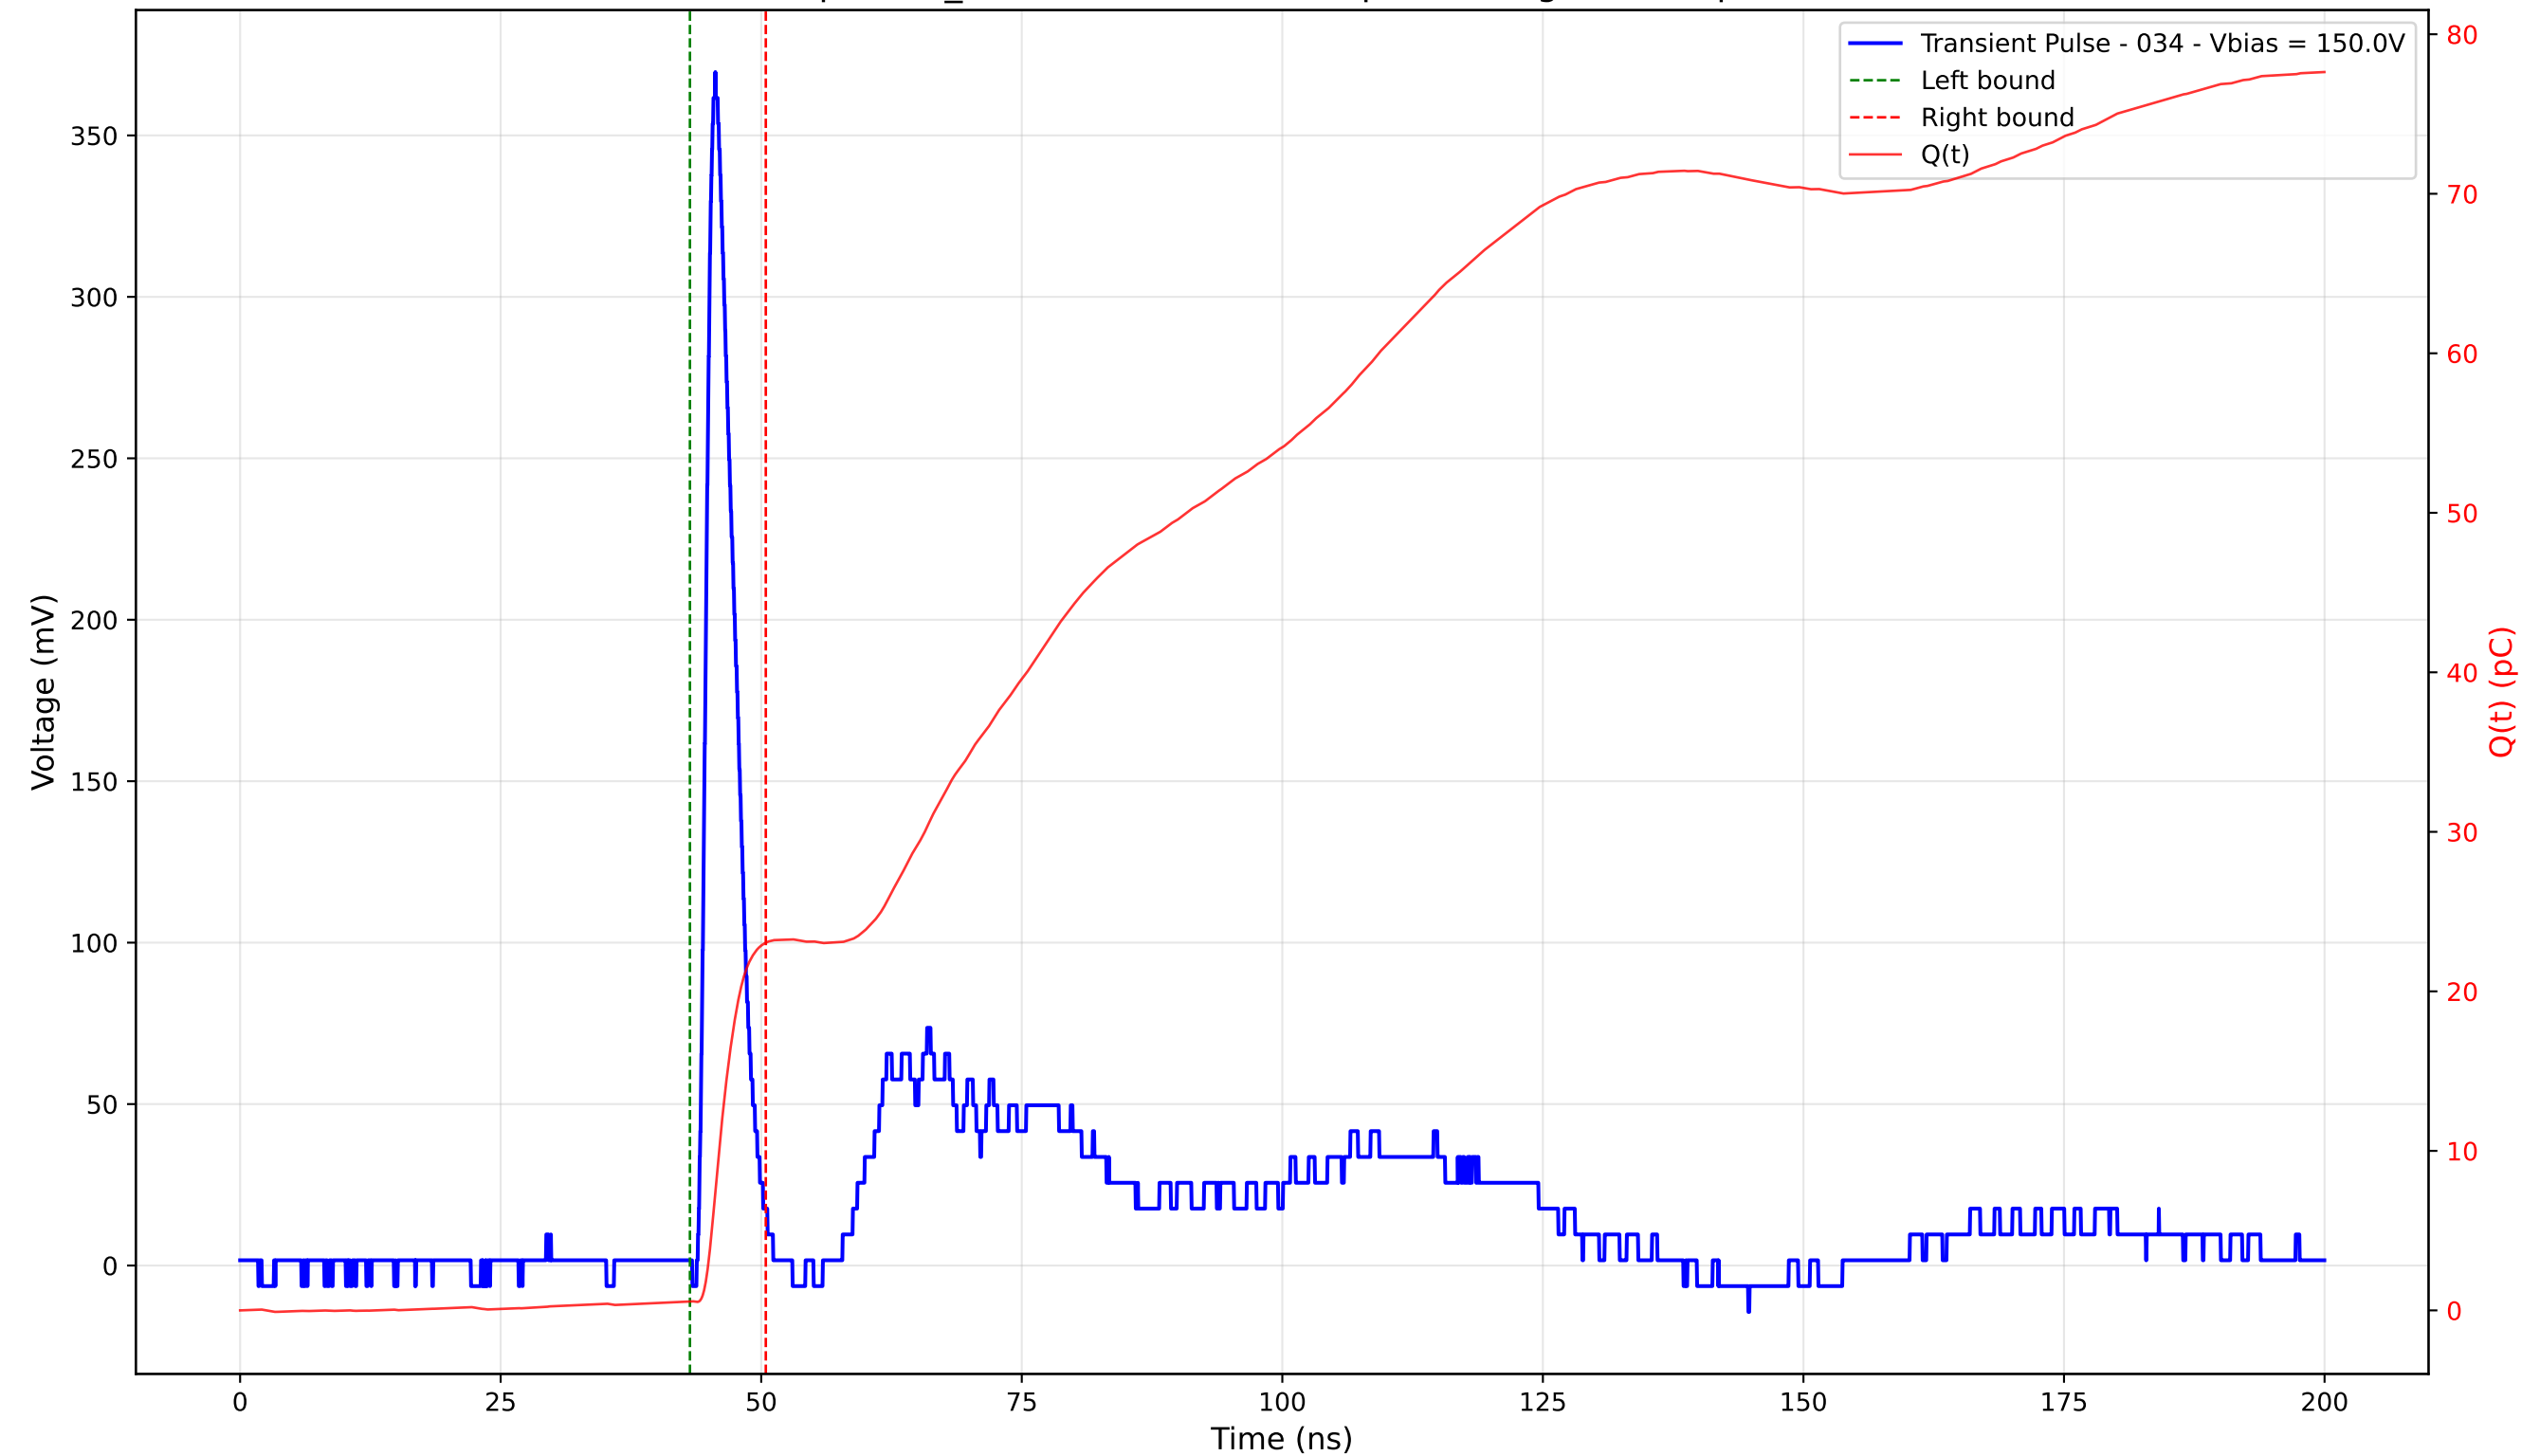


Transient Pulse - Sample: TD_4004 - Position: 340.0 μm - Charge: 21.93 pC - Rise Time: 1.01 ns

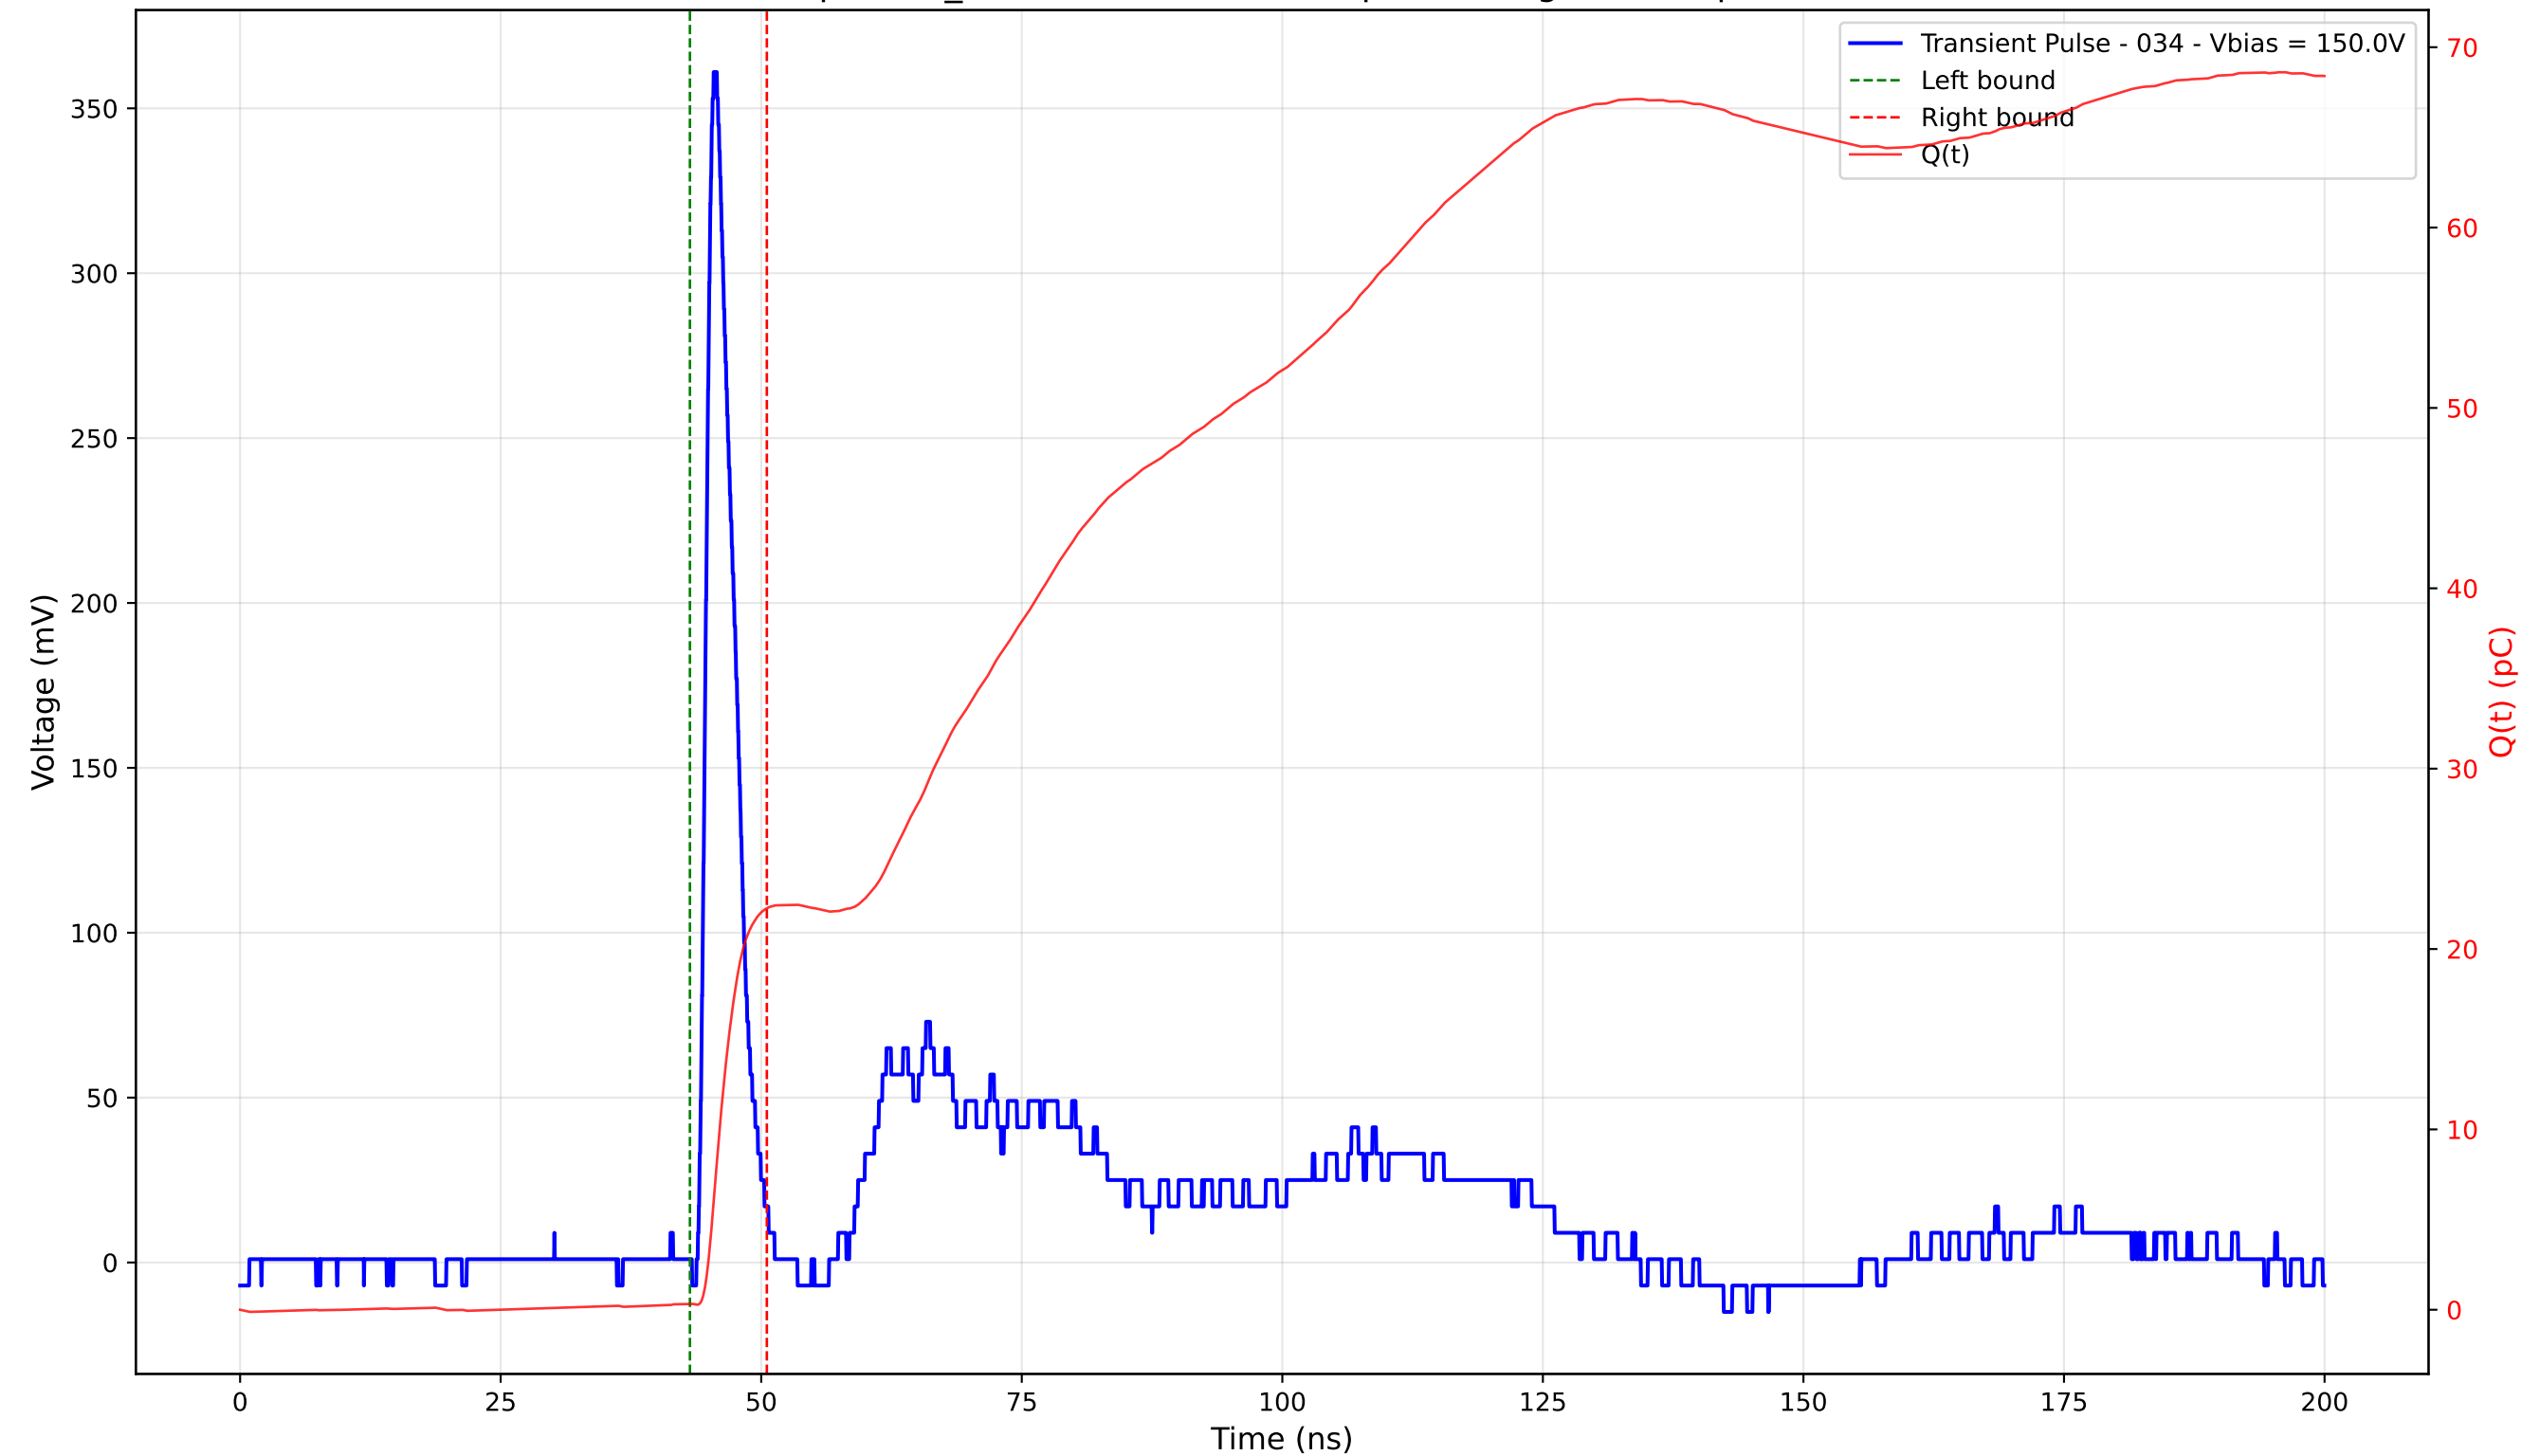


Transient Pulse - Sample: TD_4004 - Position: 345.0 μm - Charge: 22.13 pC - Rise Time: 1.05 ns

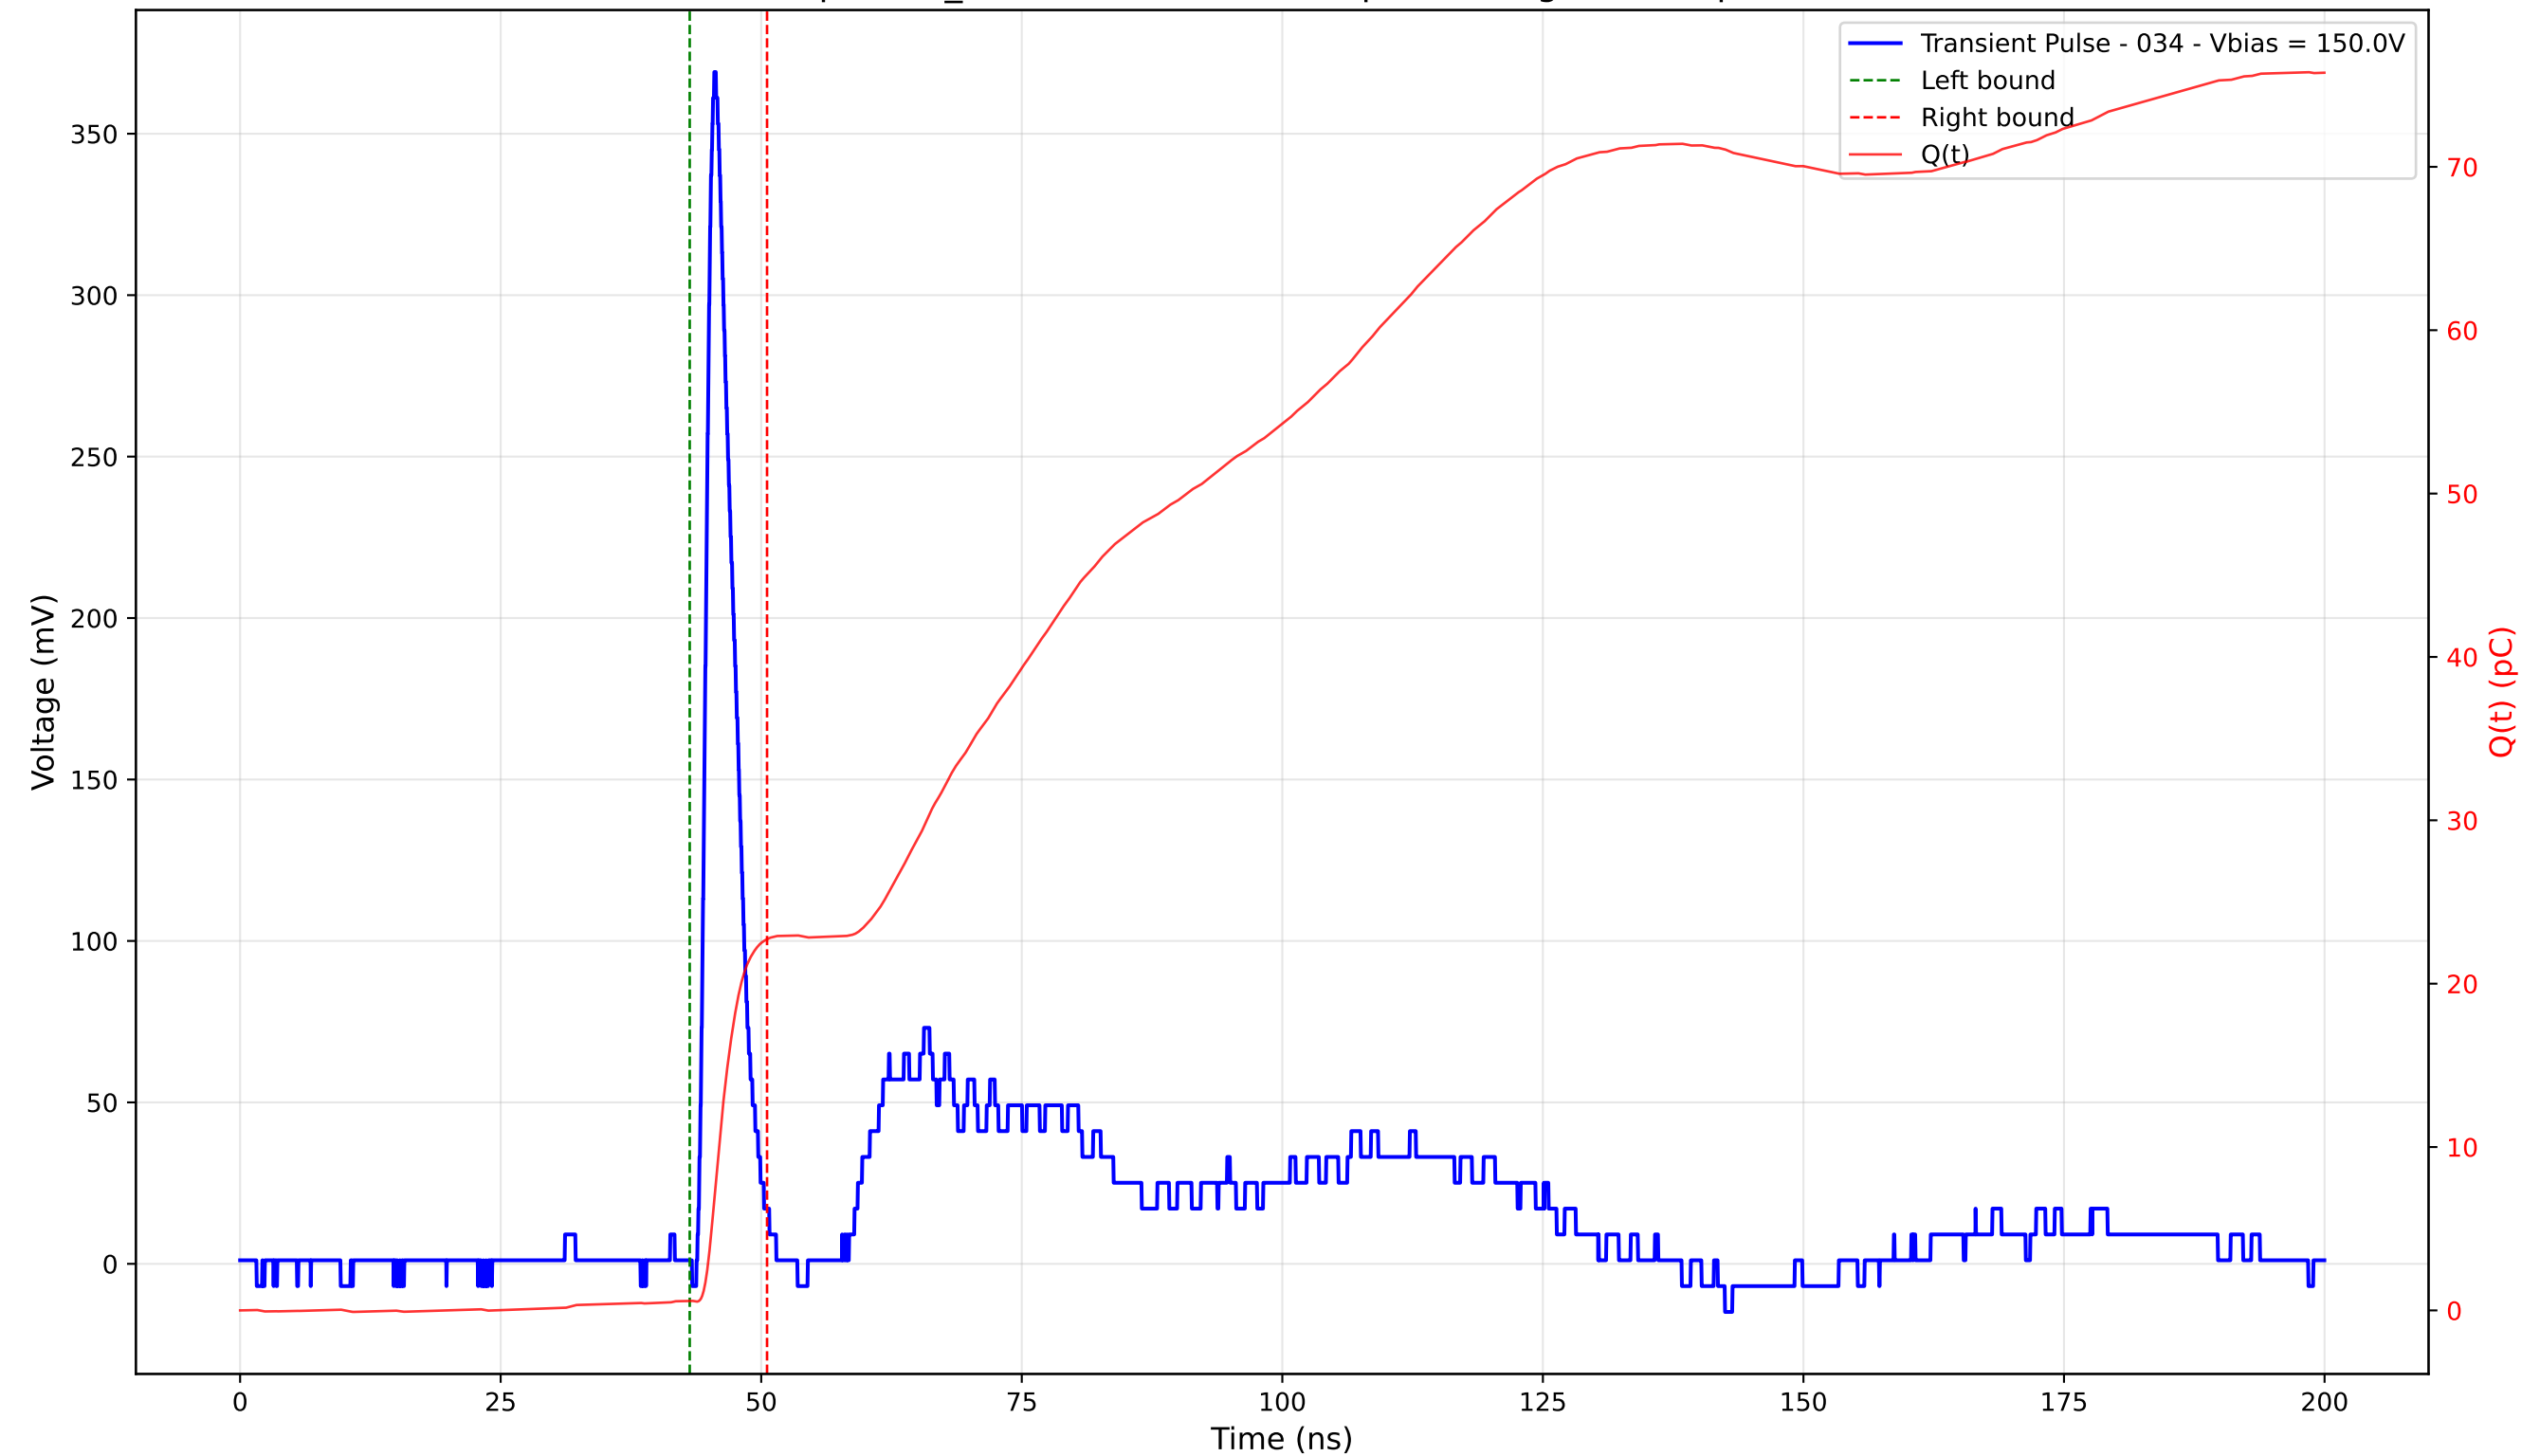


Transient Pulse - Sample: TD_4004 - Position: 350.0 μm - Charge: 21.55 pC - Rise Time: 1.05 ns

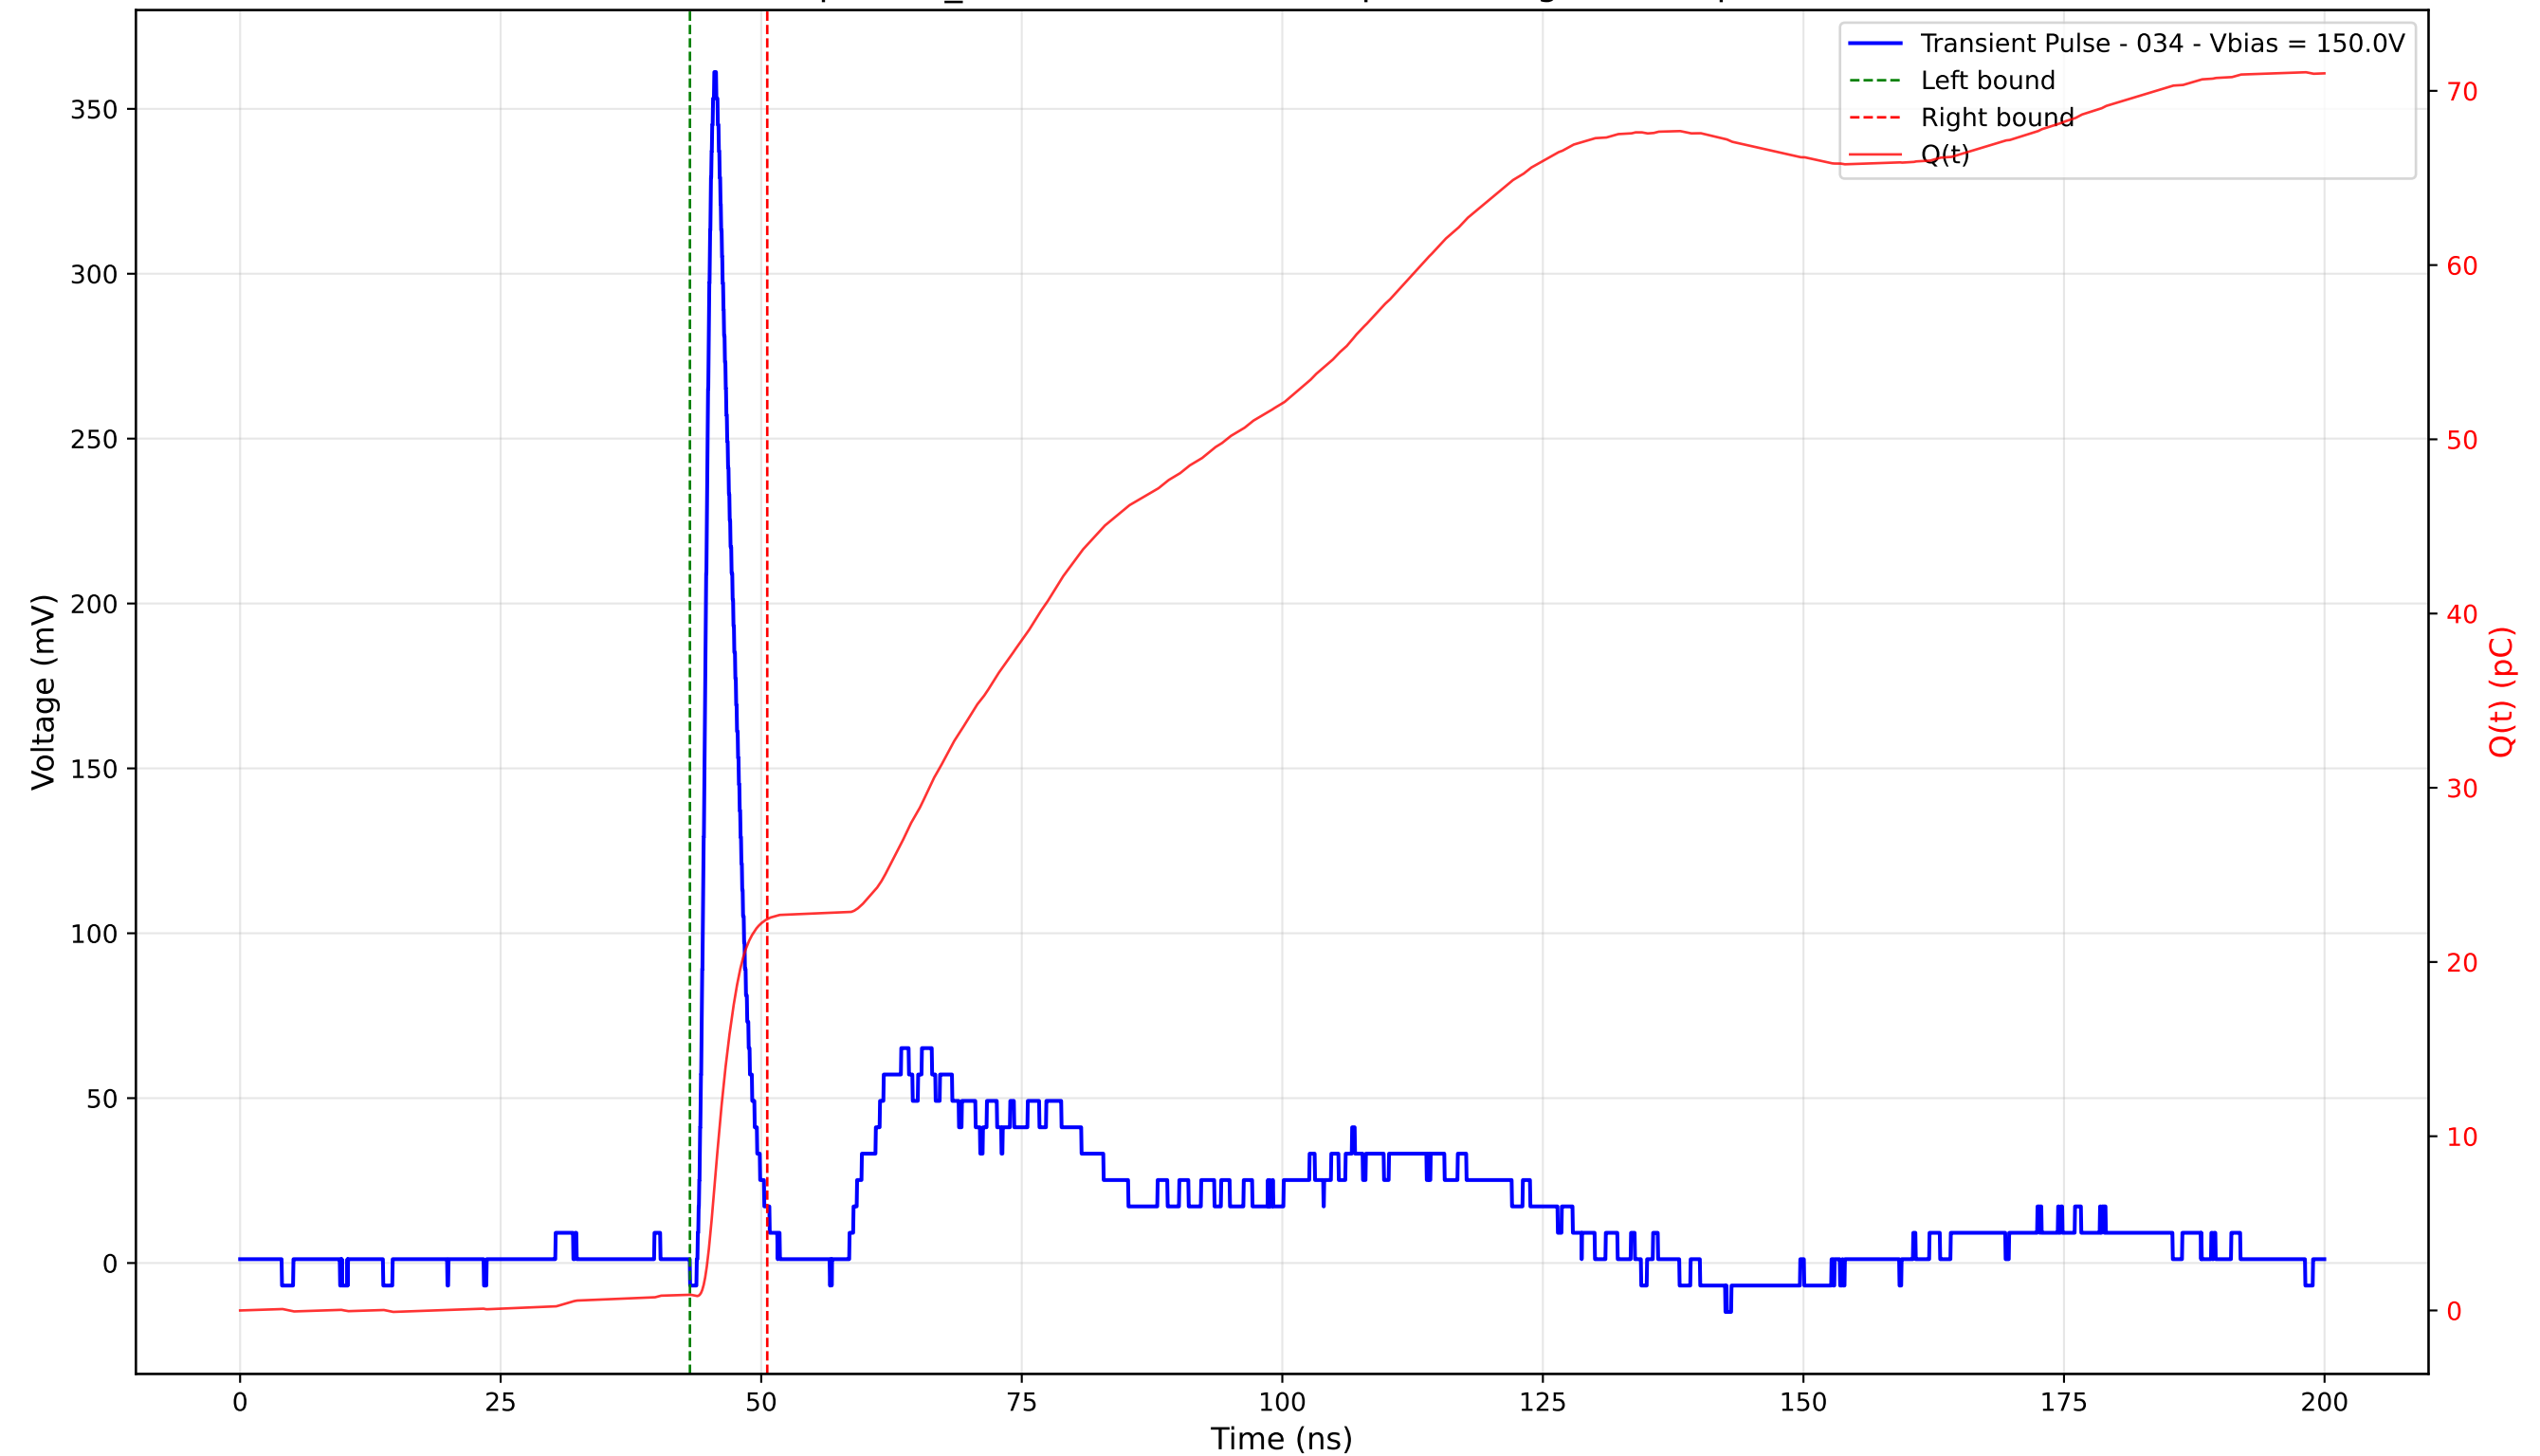


Transient Pulse - Sample: TD_4004 - Position: 355.0 μm - Charge: 20.64 pC - Rise Time: 1.00 ns

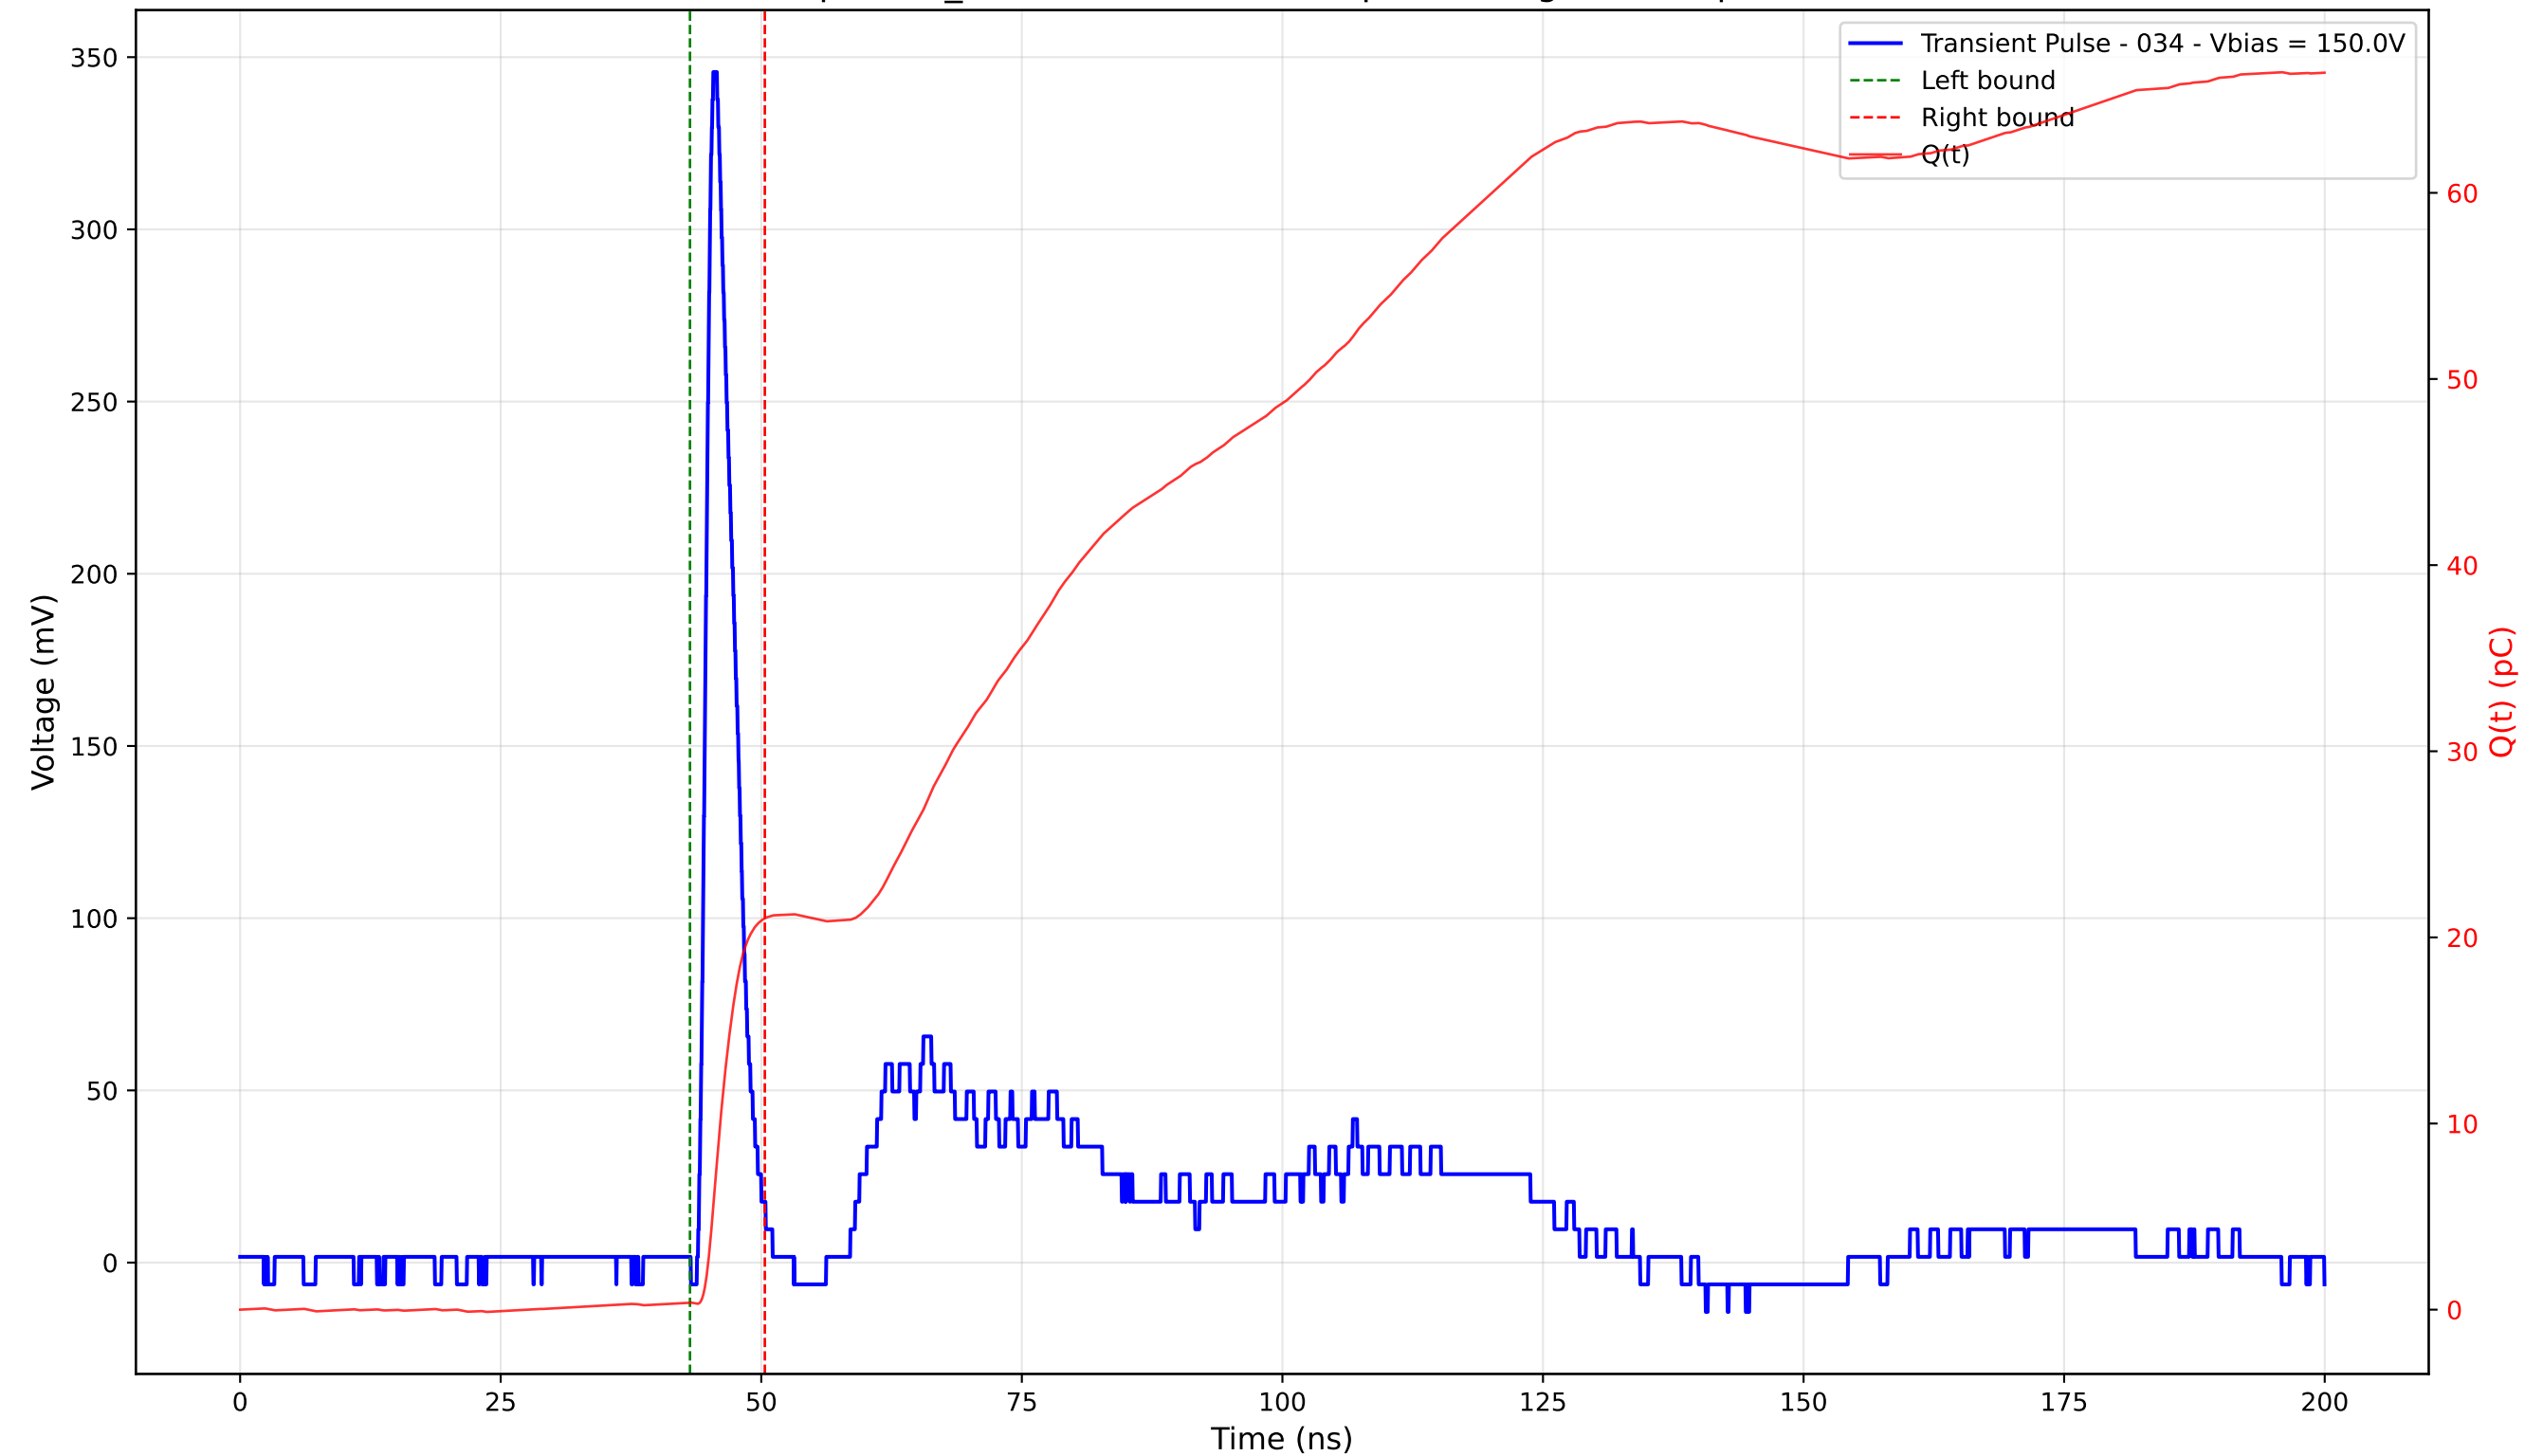


Transient Pulse - Sample: TD_4004 - Position: 360.0 μm - Charge: 20.36 pC - Rise Time: 1.04 ns

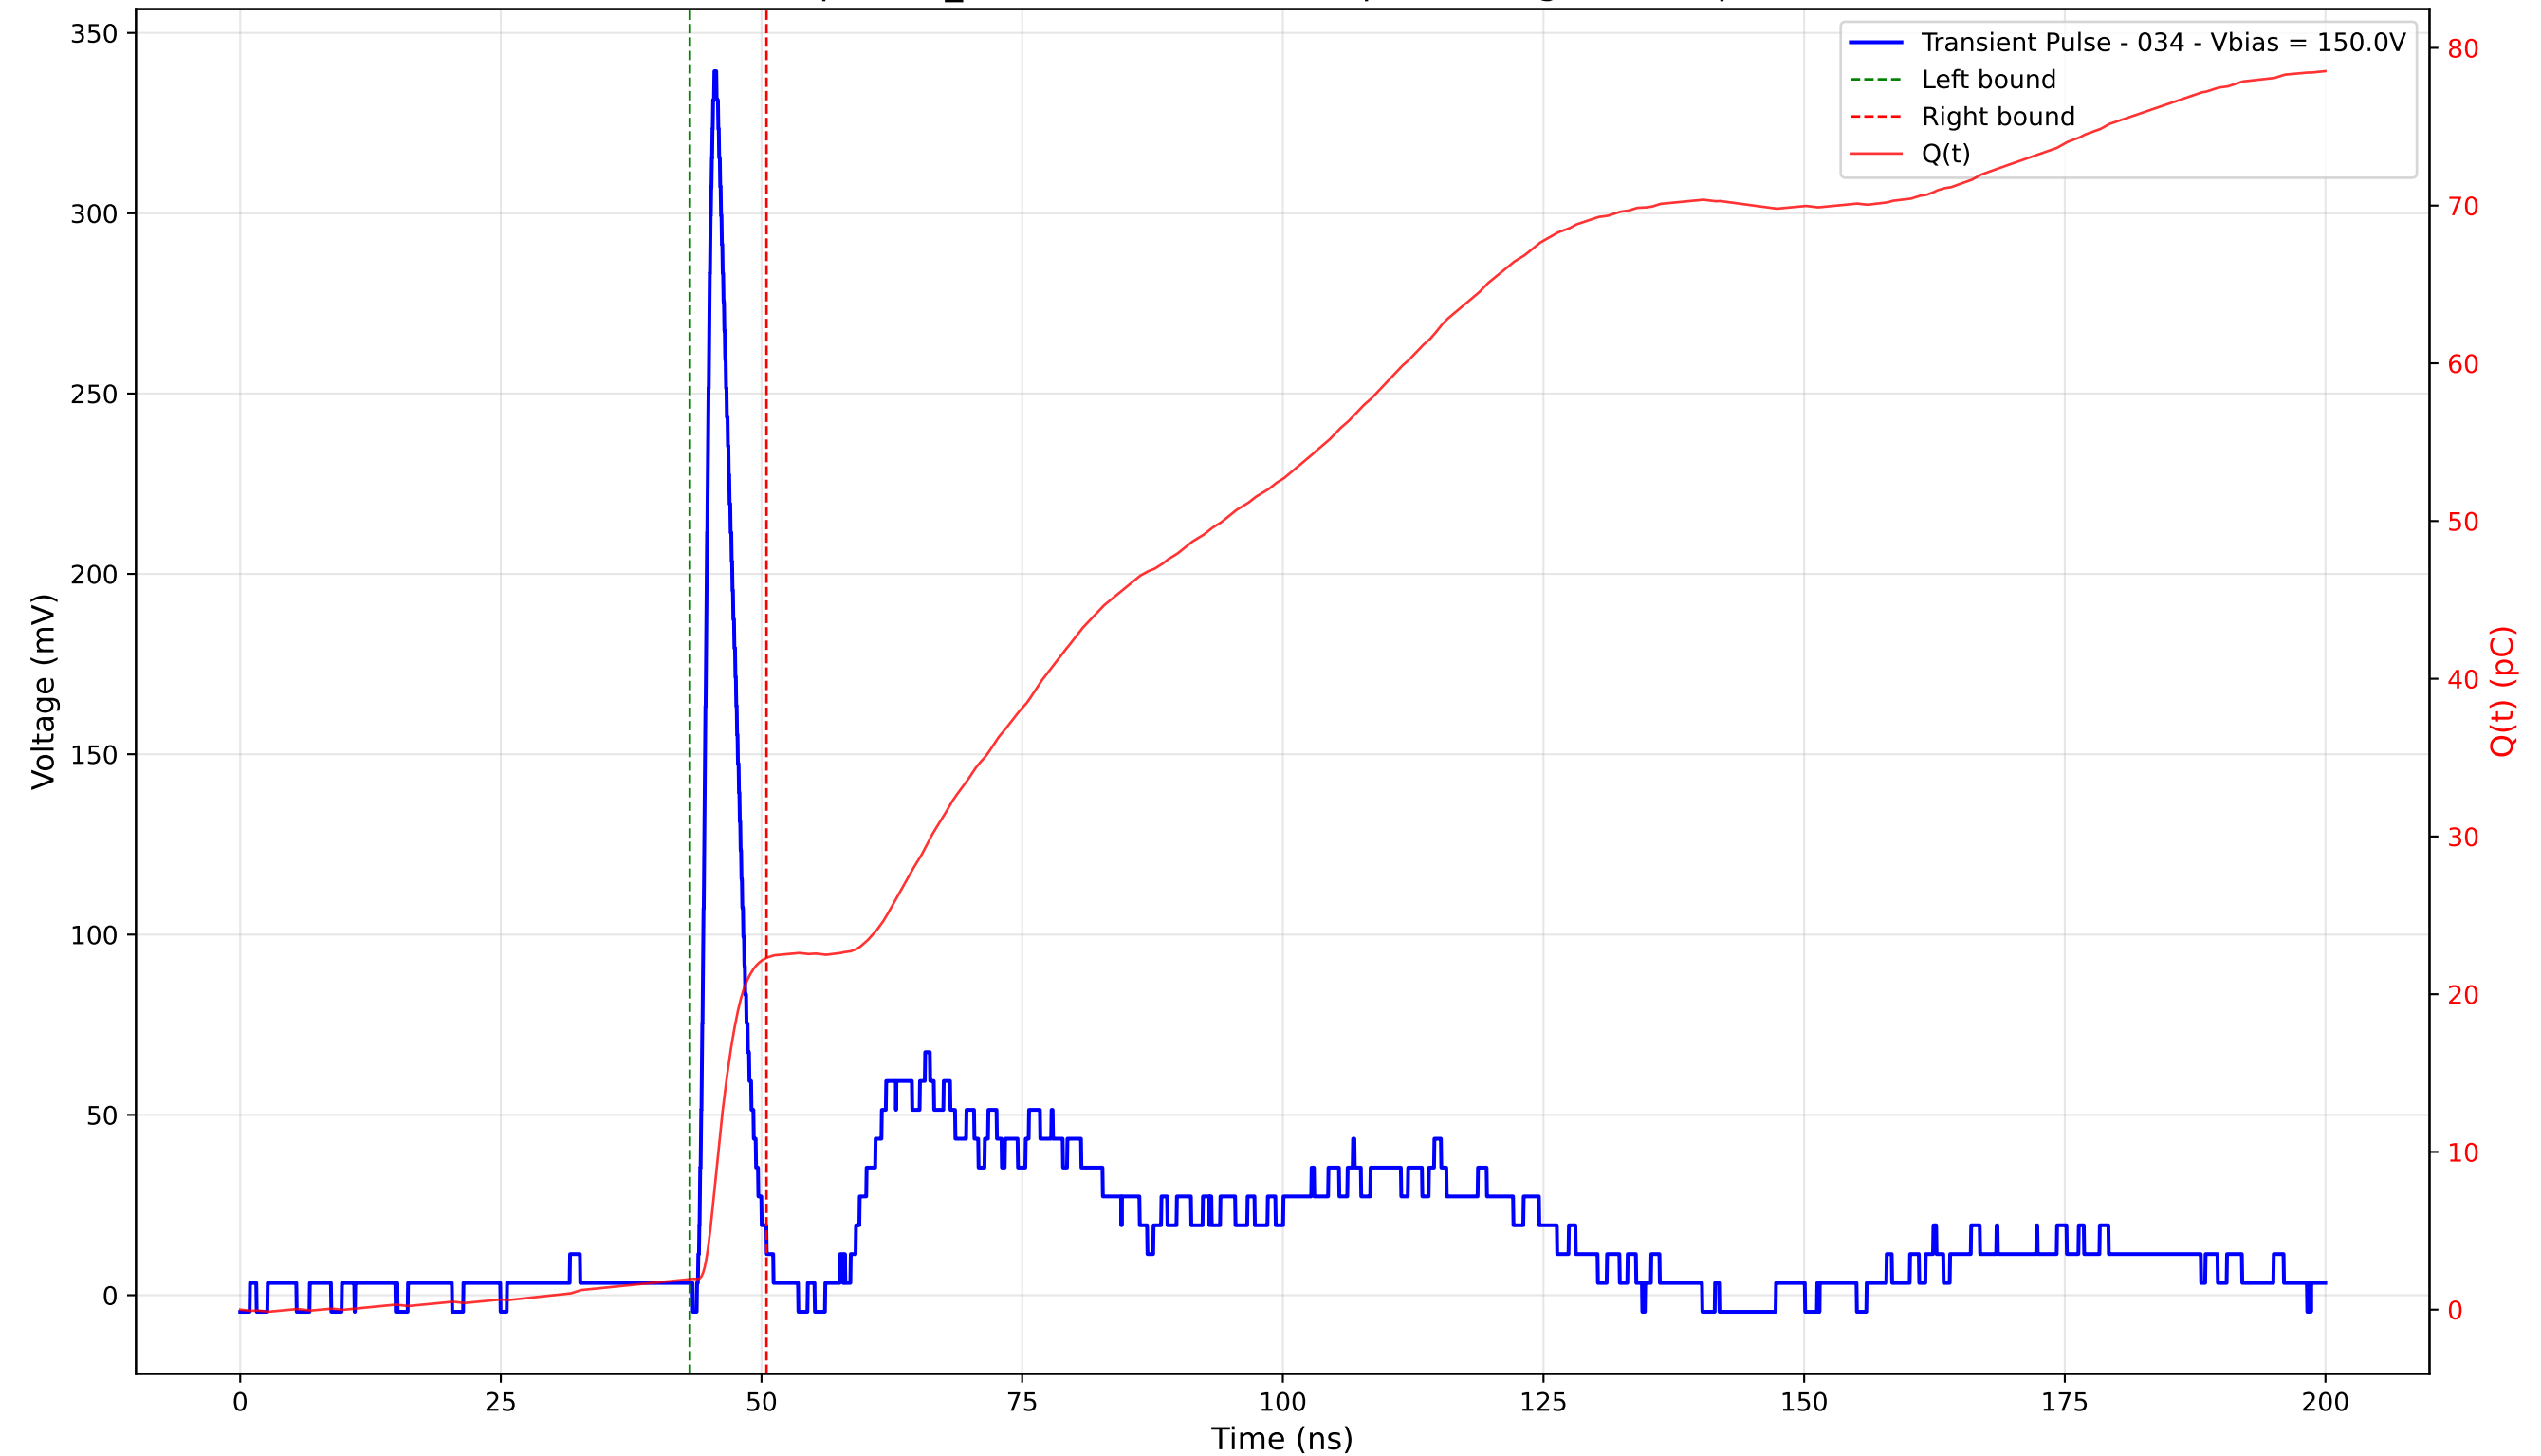


Transient Pulse - Sample: TD_4004 - Position: 365.0 μm - Charge: 19.67 pC - Rise Time: 1.00 ns

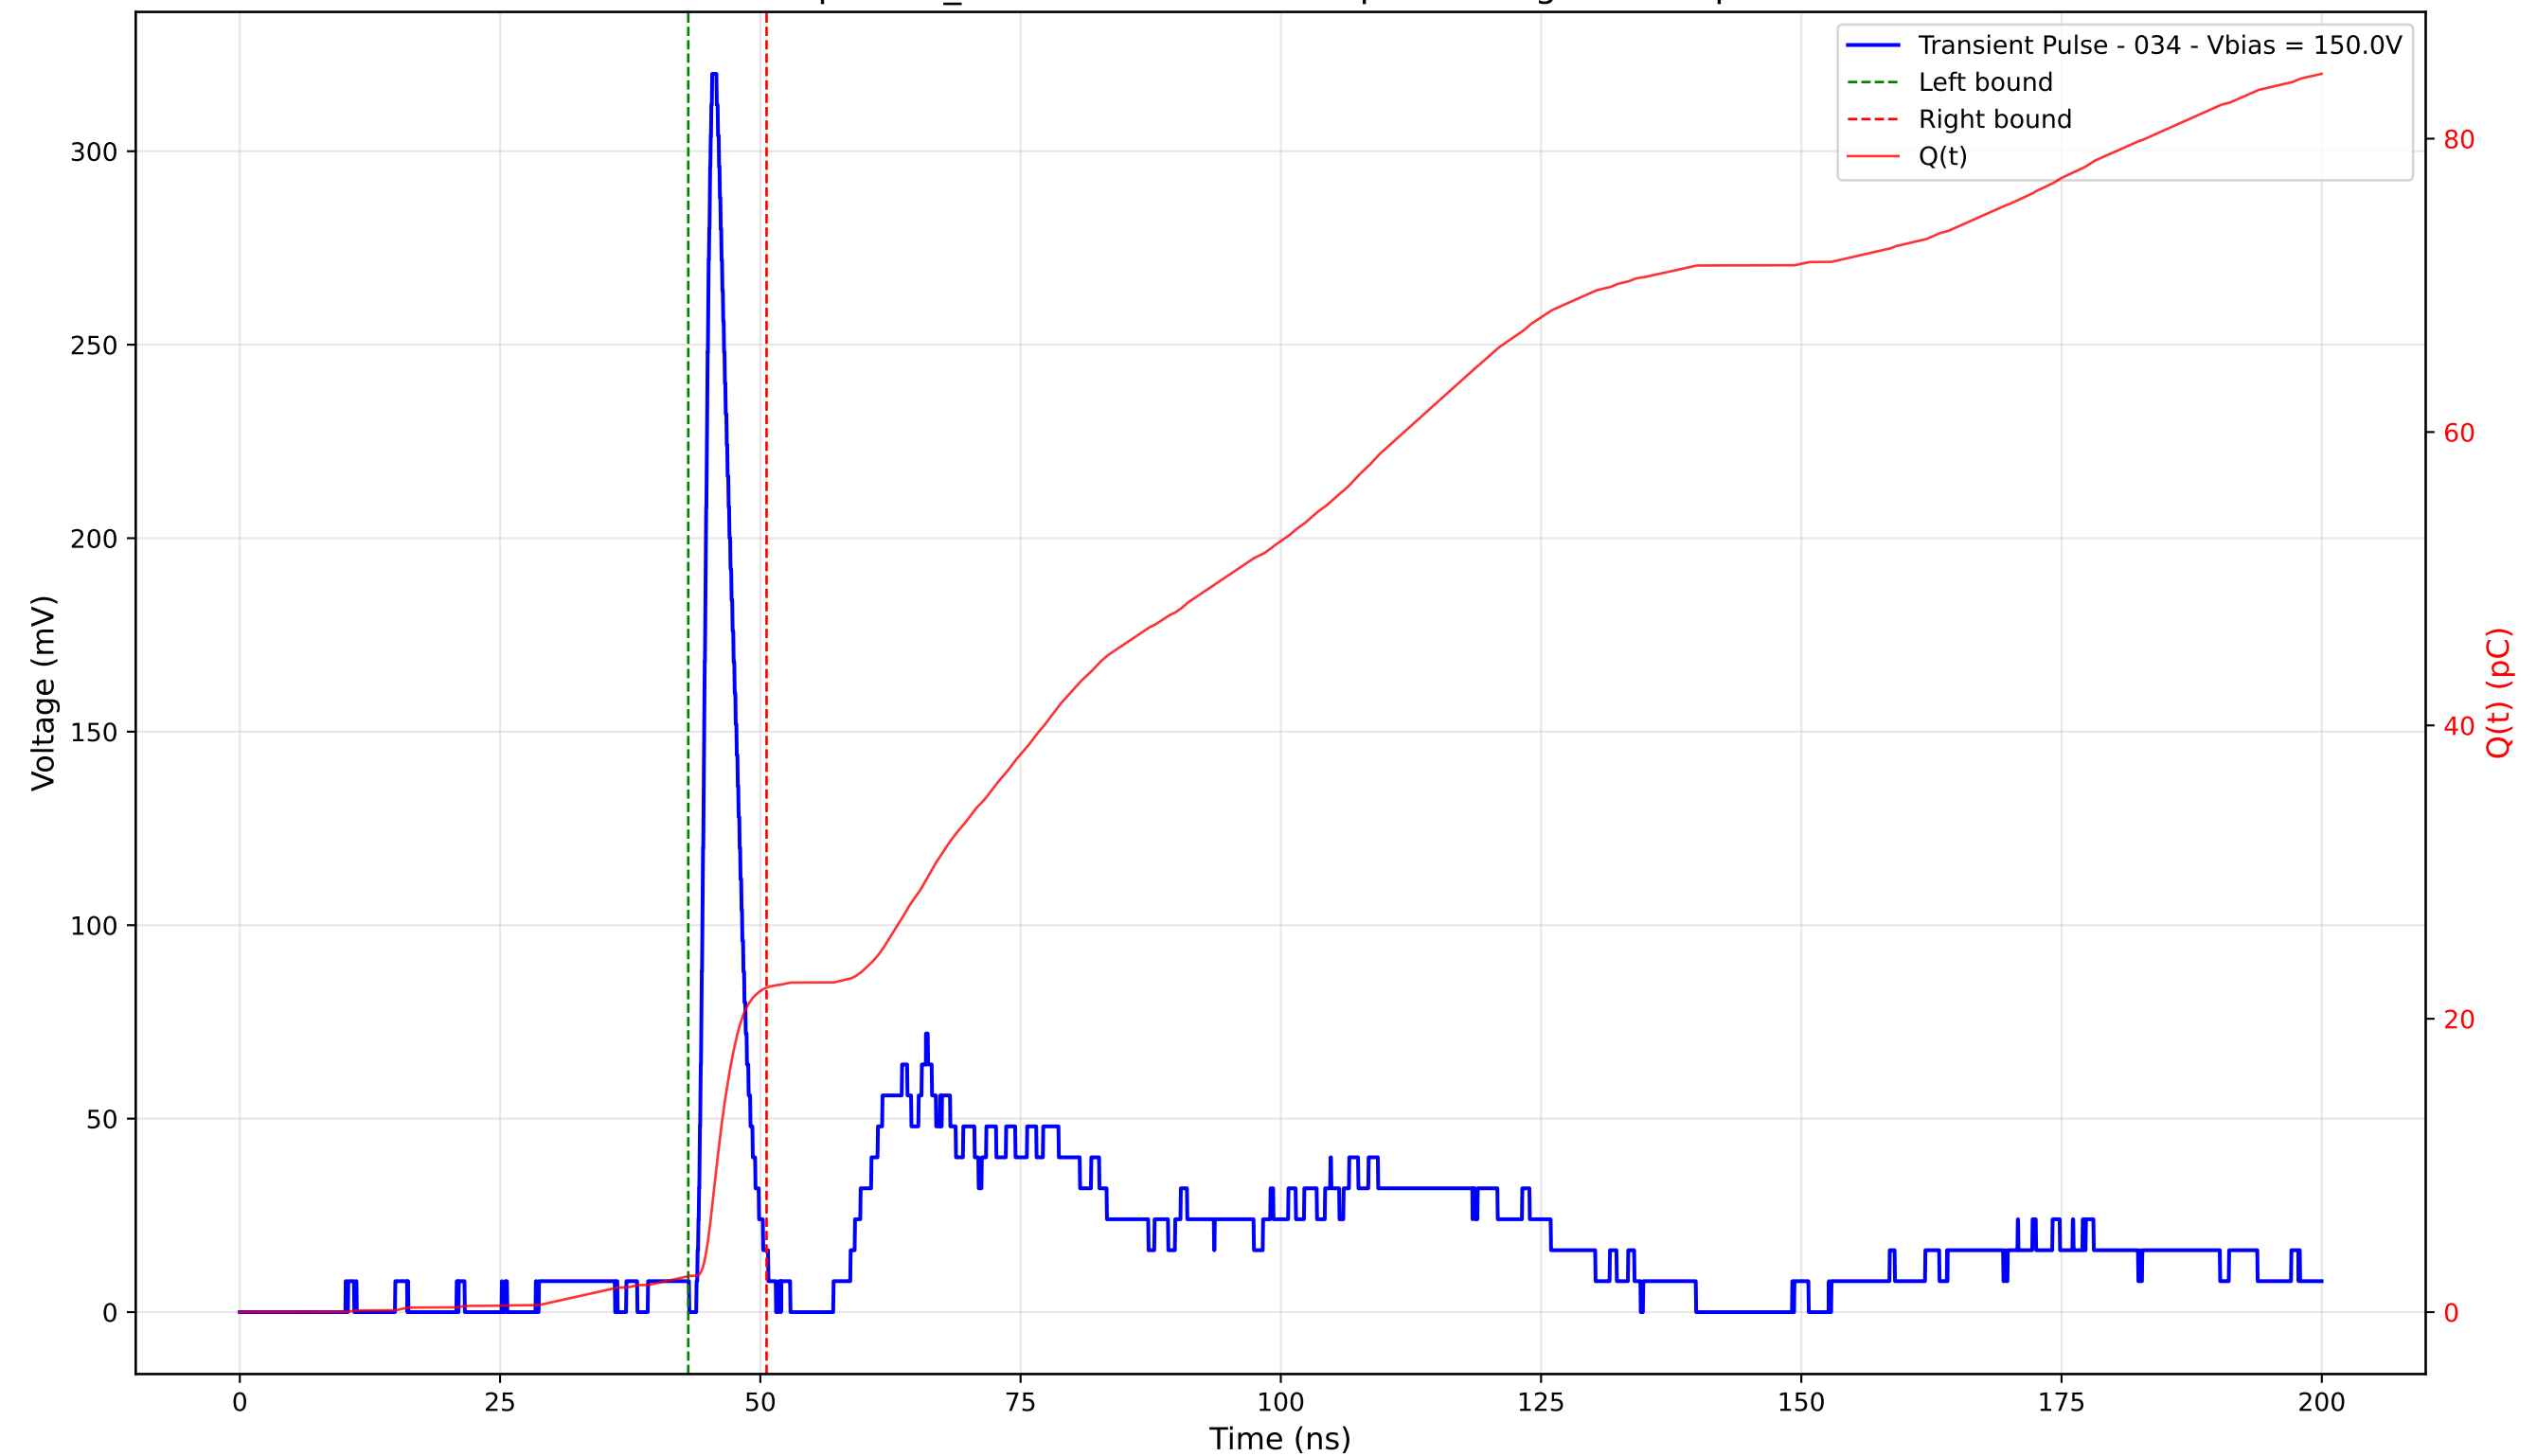


Transient Pulse - Sample: TD_4004 - Position: 370.0 μm - Charge: 18.41 pC - Rise Time: 1.05 ns

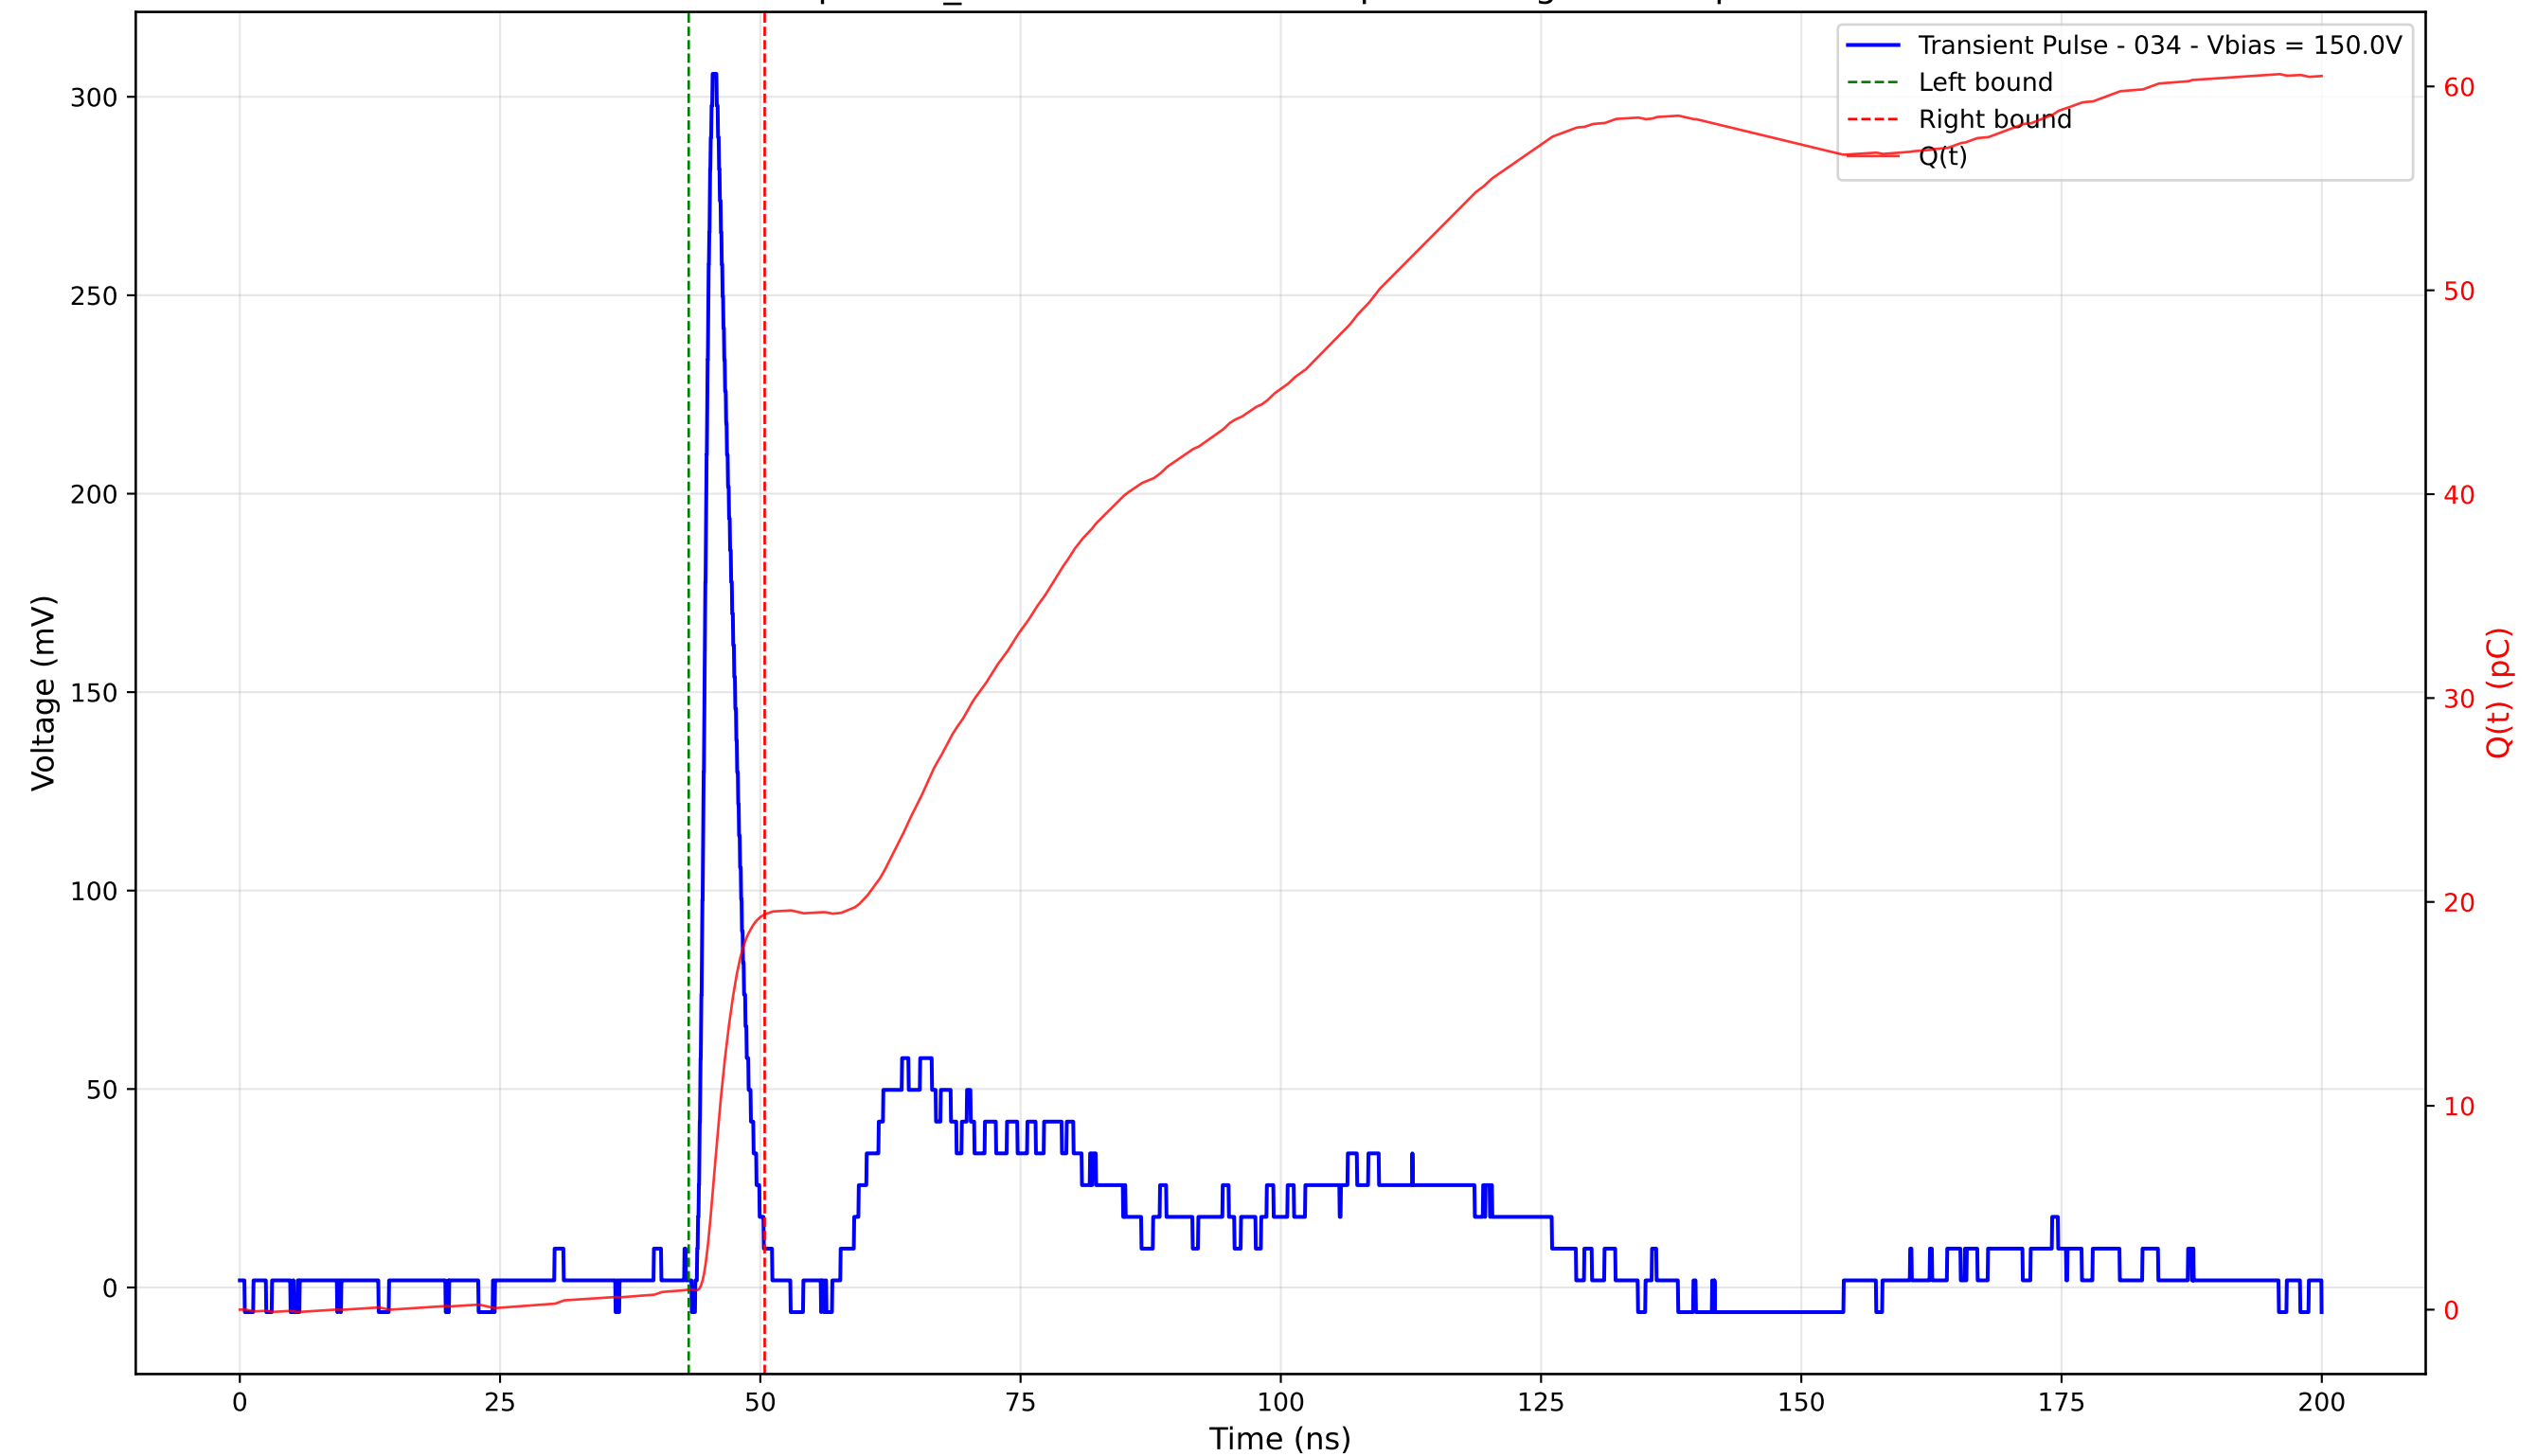


Transient Pulse - Sample: TD_4004 - Position: 375.0 μm - Charge: 18.52 pC - Rise Time: 1.04 ns

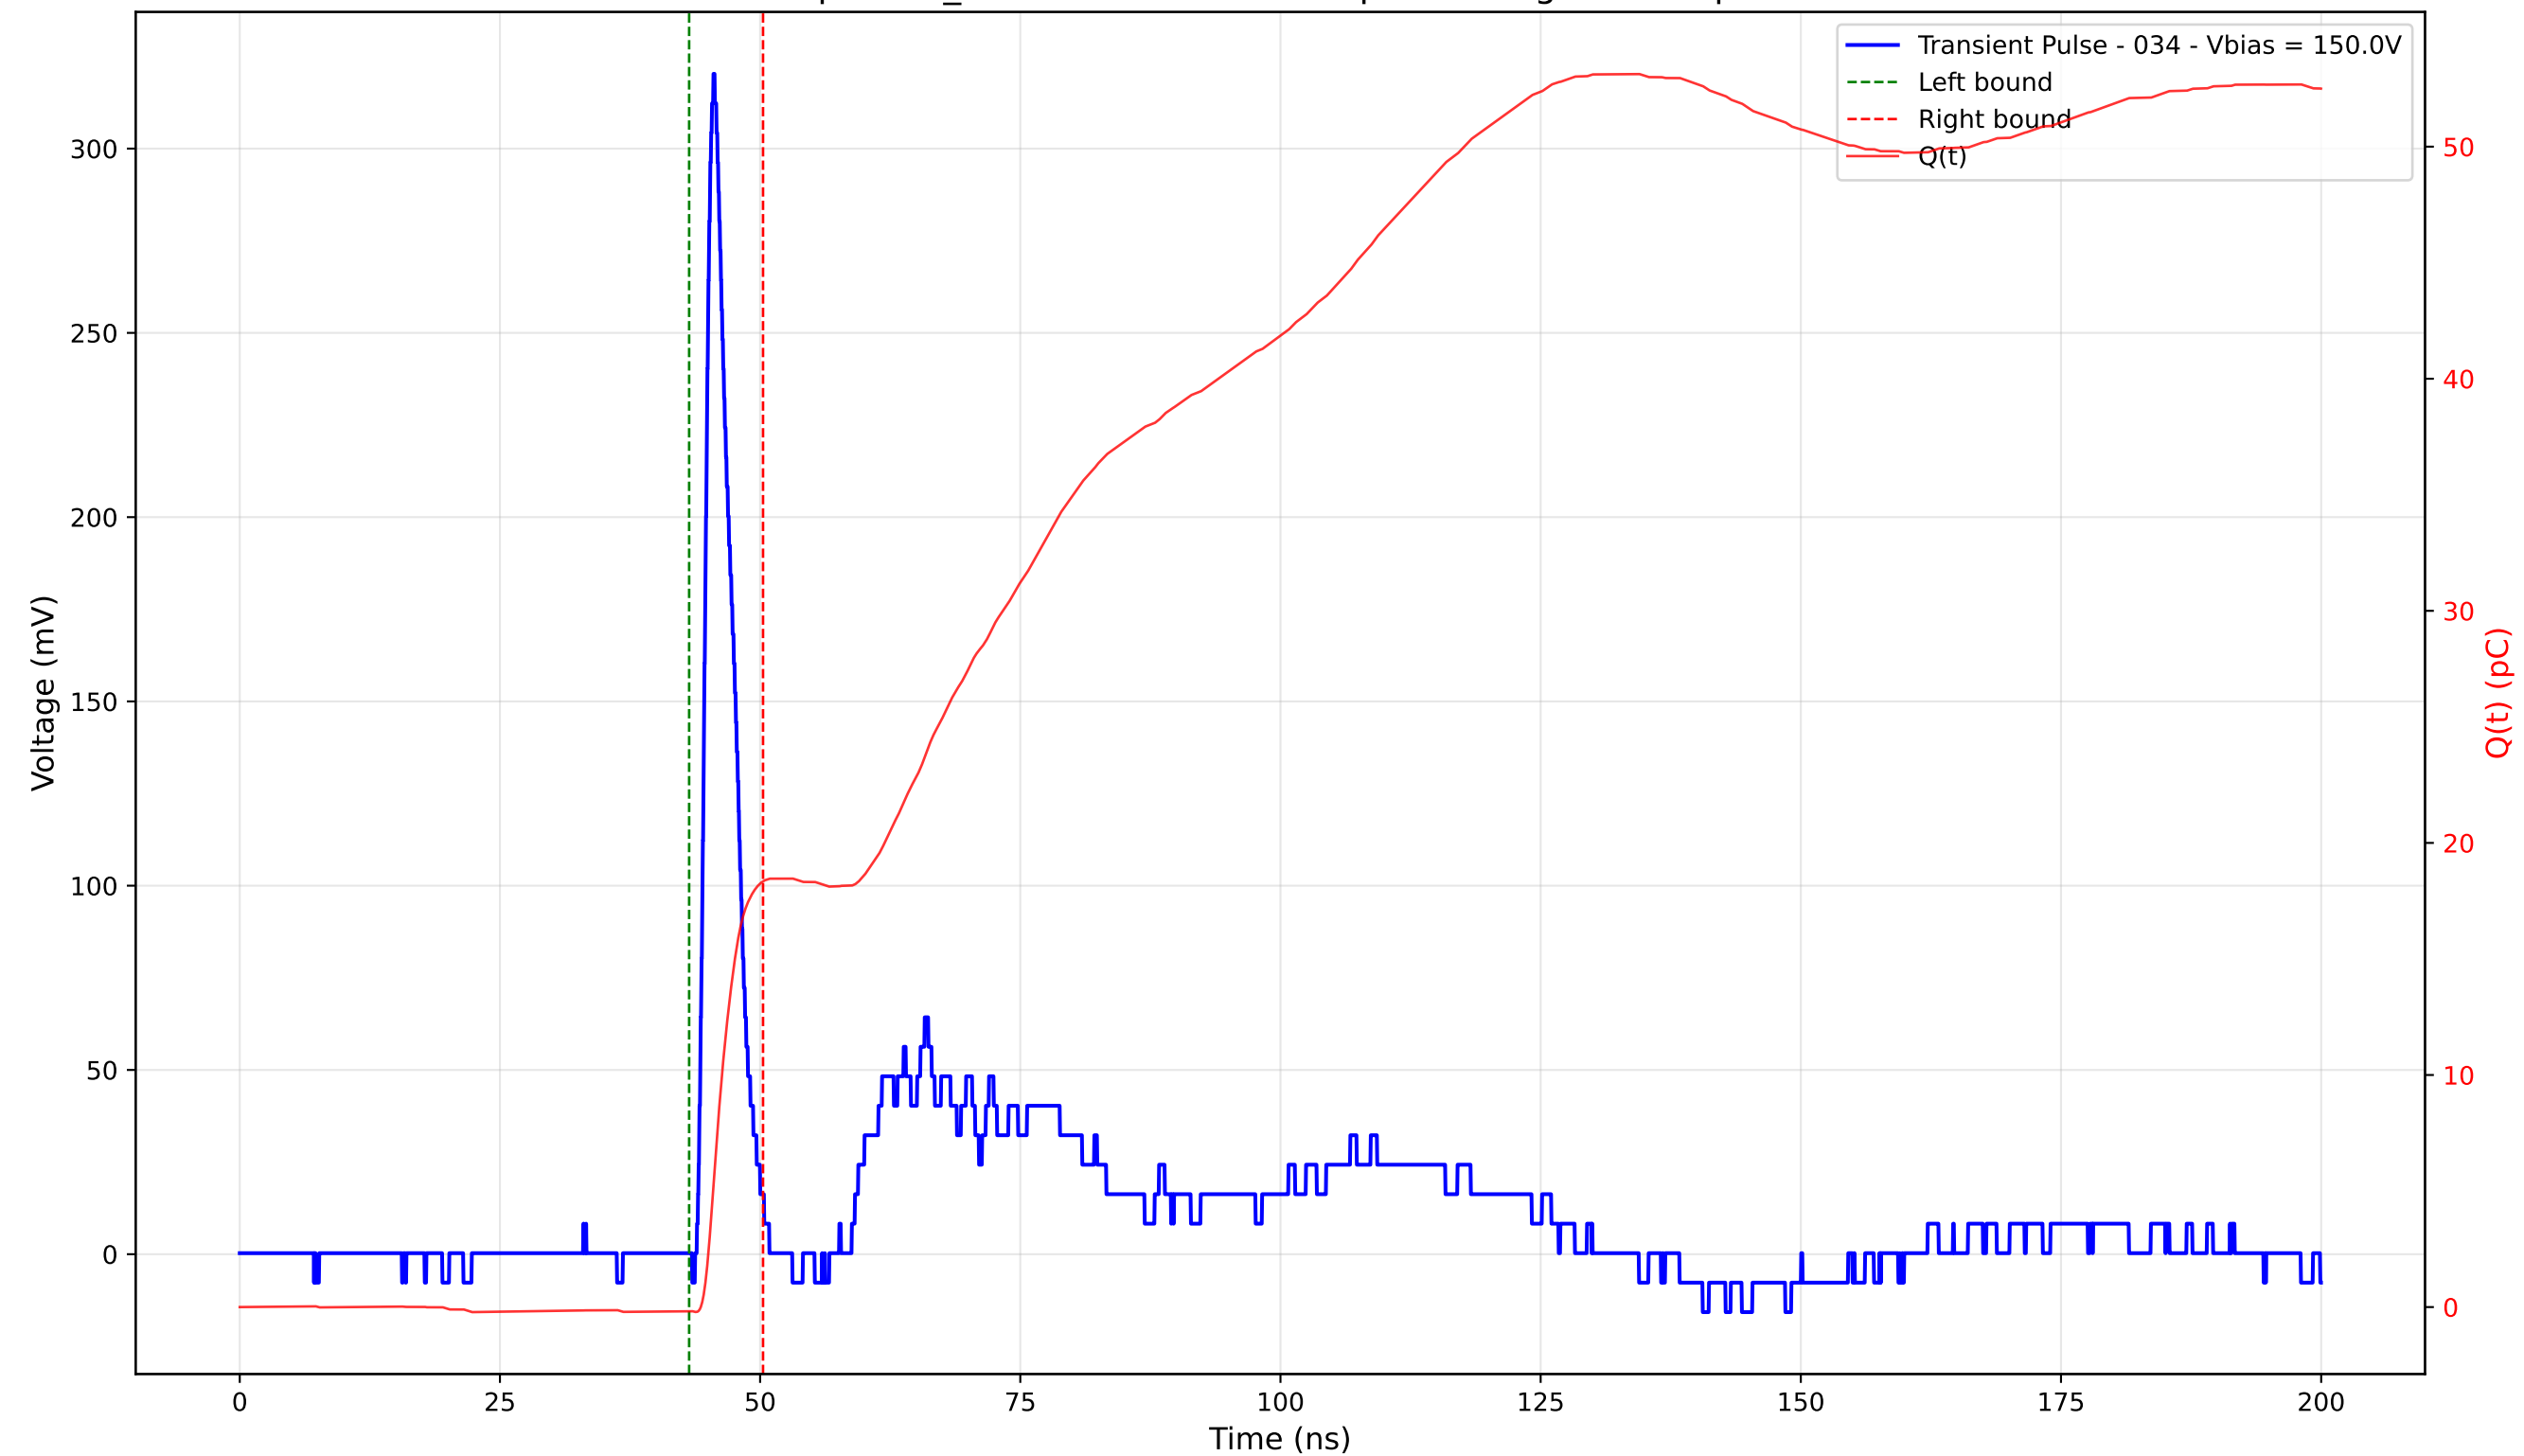


Transient Pulse - Sample: TD_4004 - Position: 380.0 μm - Charge: 18.67 pC - Rise Time: 1.04 ns

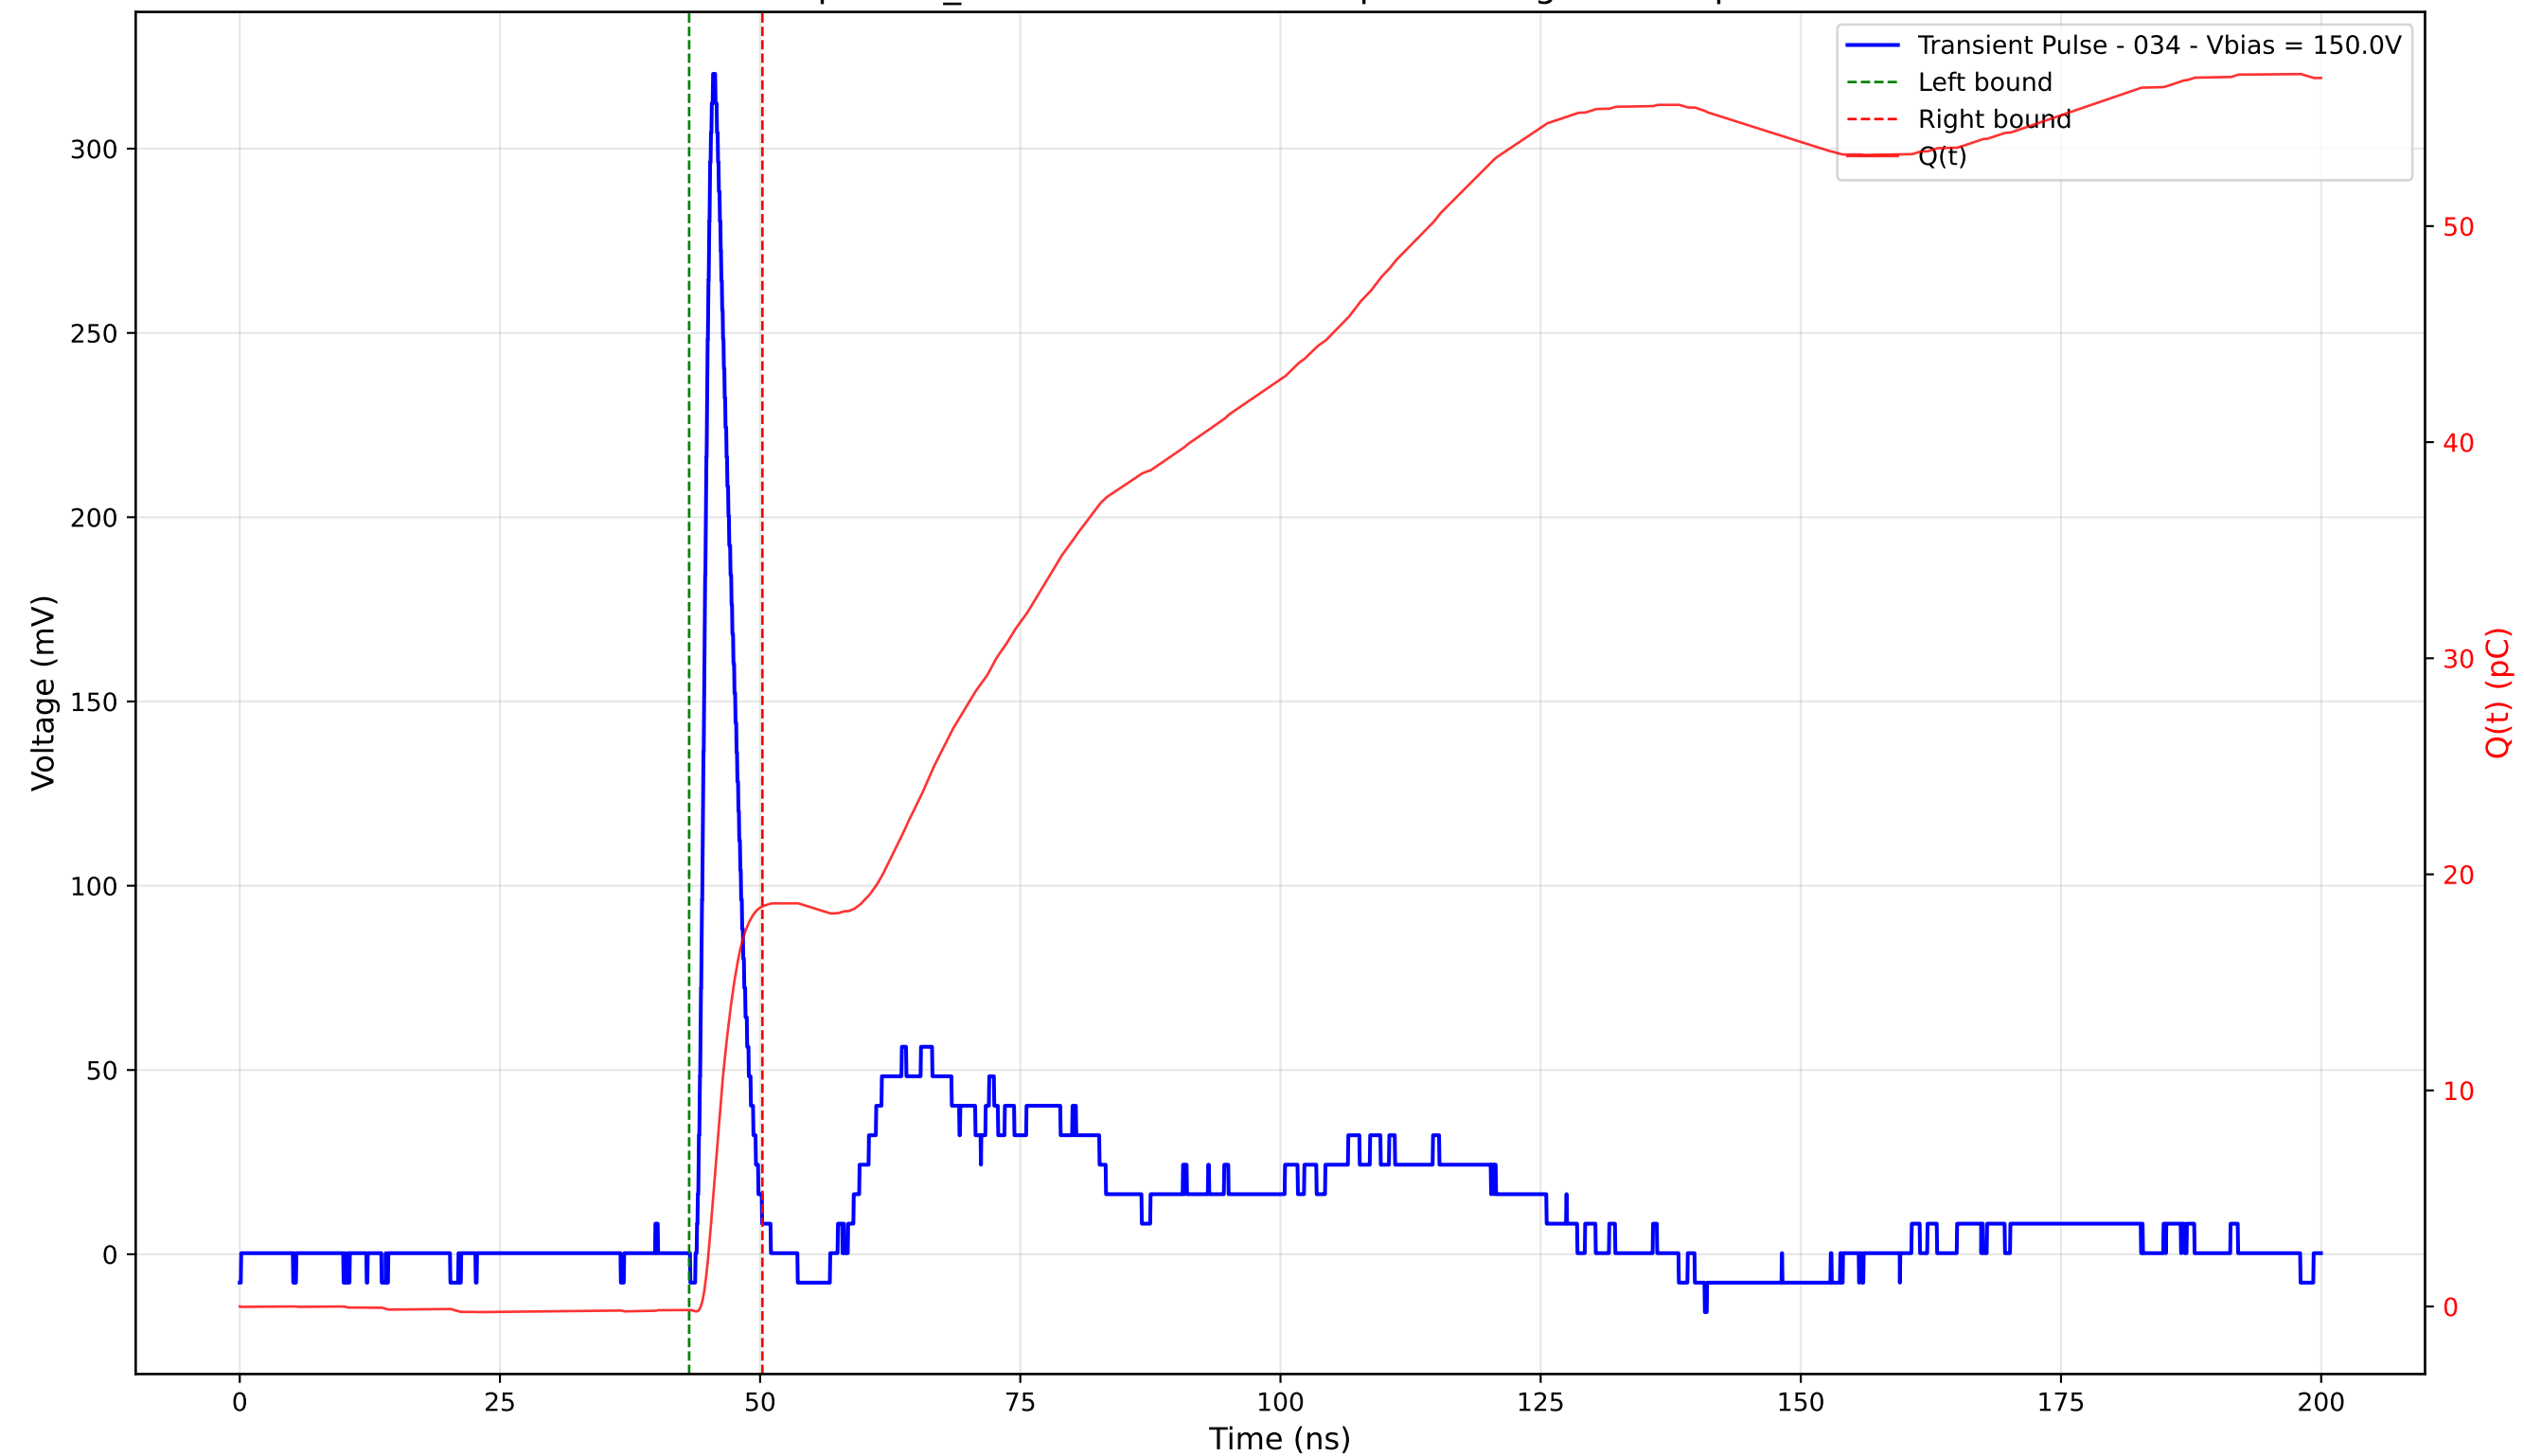


Transient Pulse - Sample: TD_4004 - Position: 385.0 μm - Charge: 17.62 pC - Rise Time: 1.07 ns

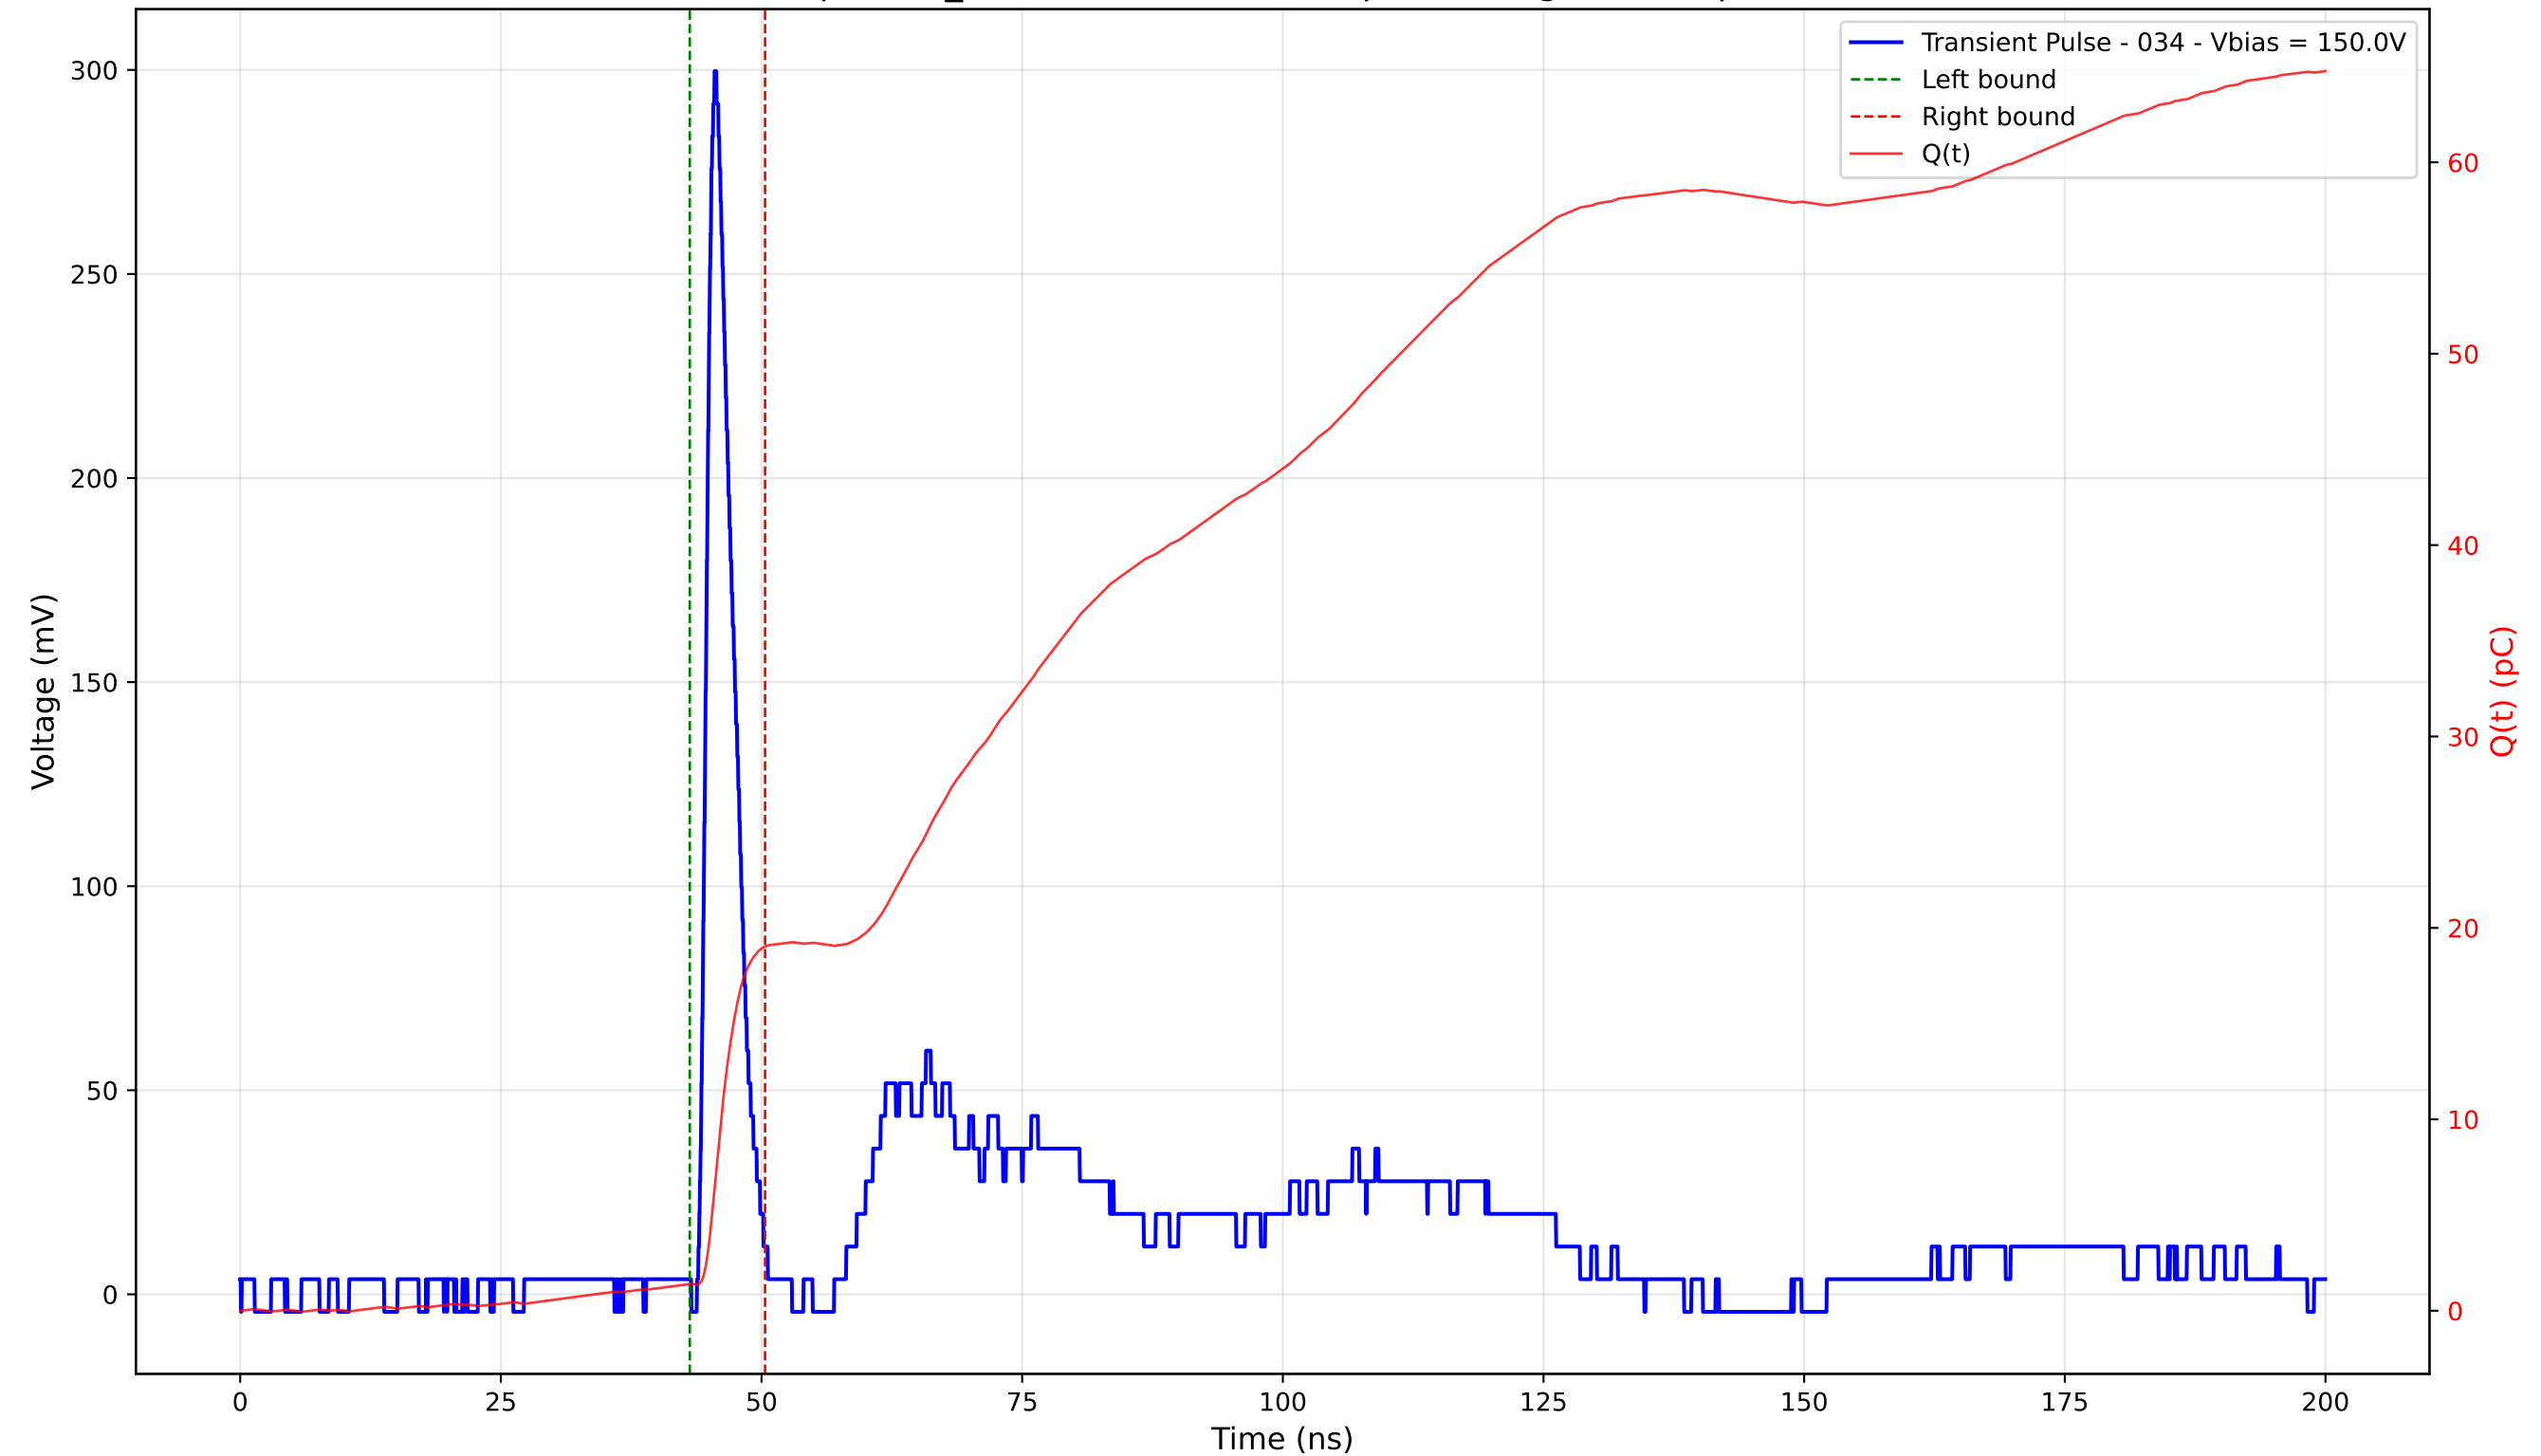


Transient Pulse - Sample: TD_4004 - Position: 390.0 μm - Charge: 15.03 pC - Rise Time: 1.01 ns

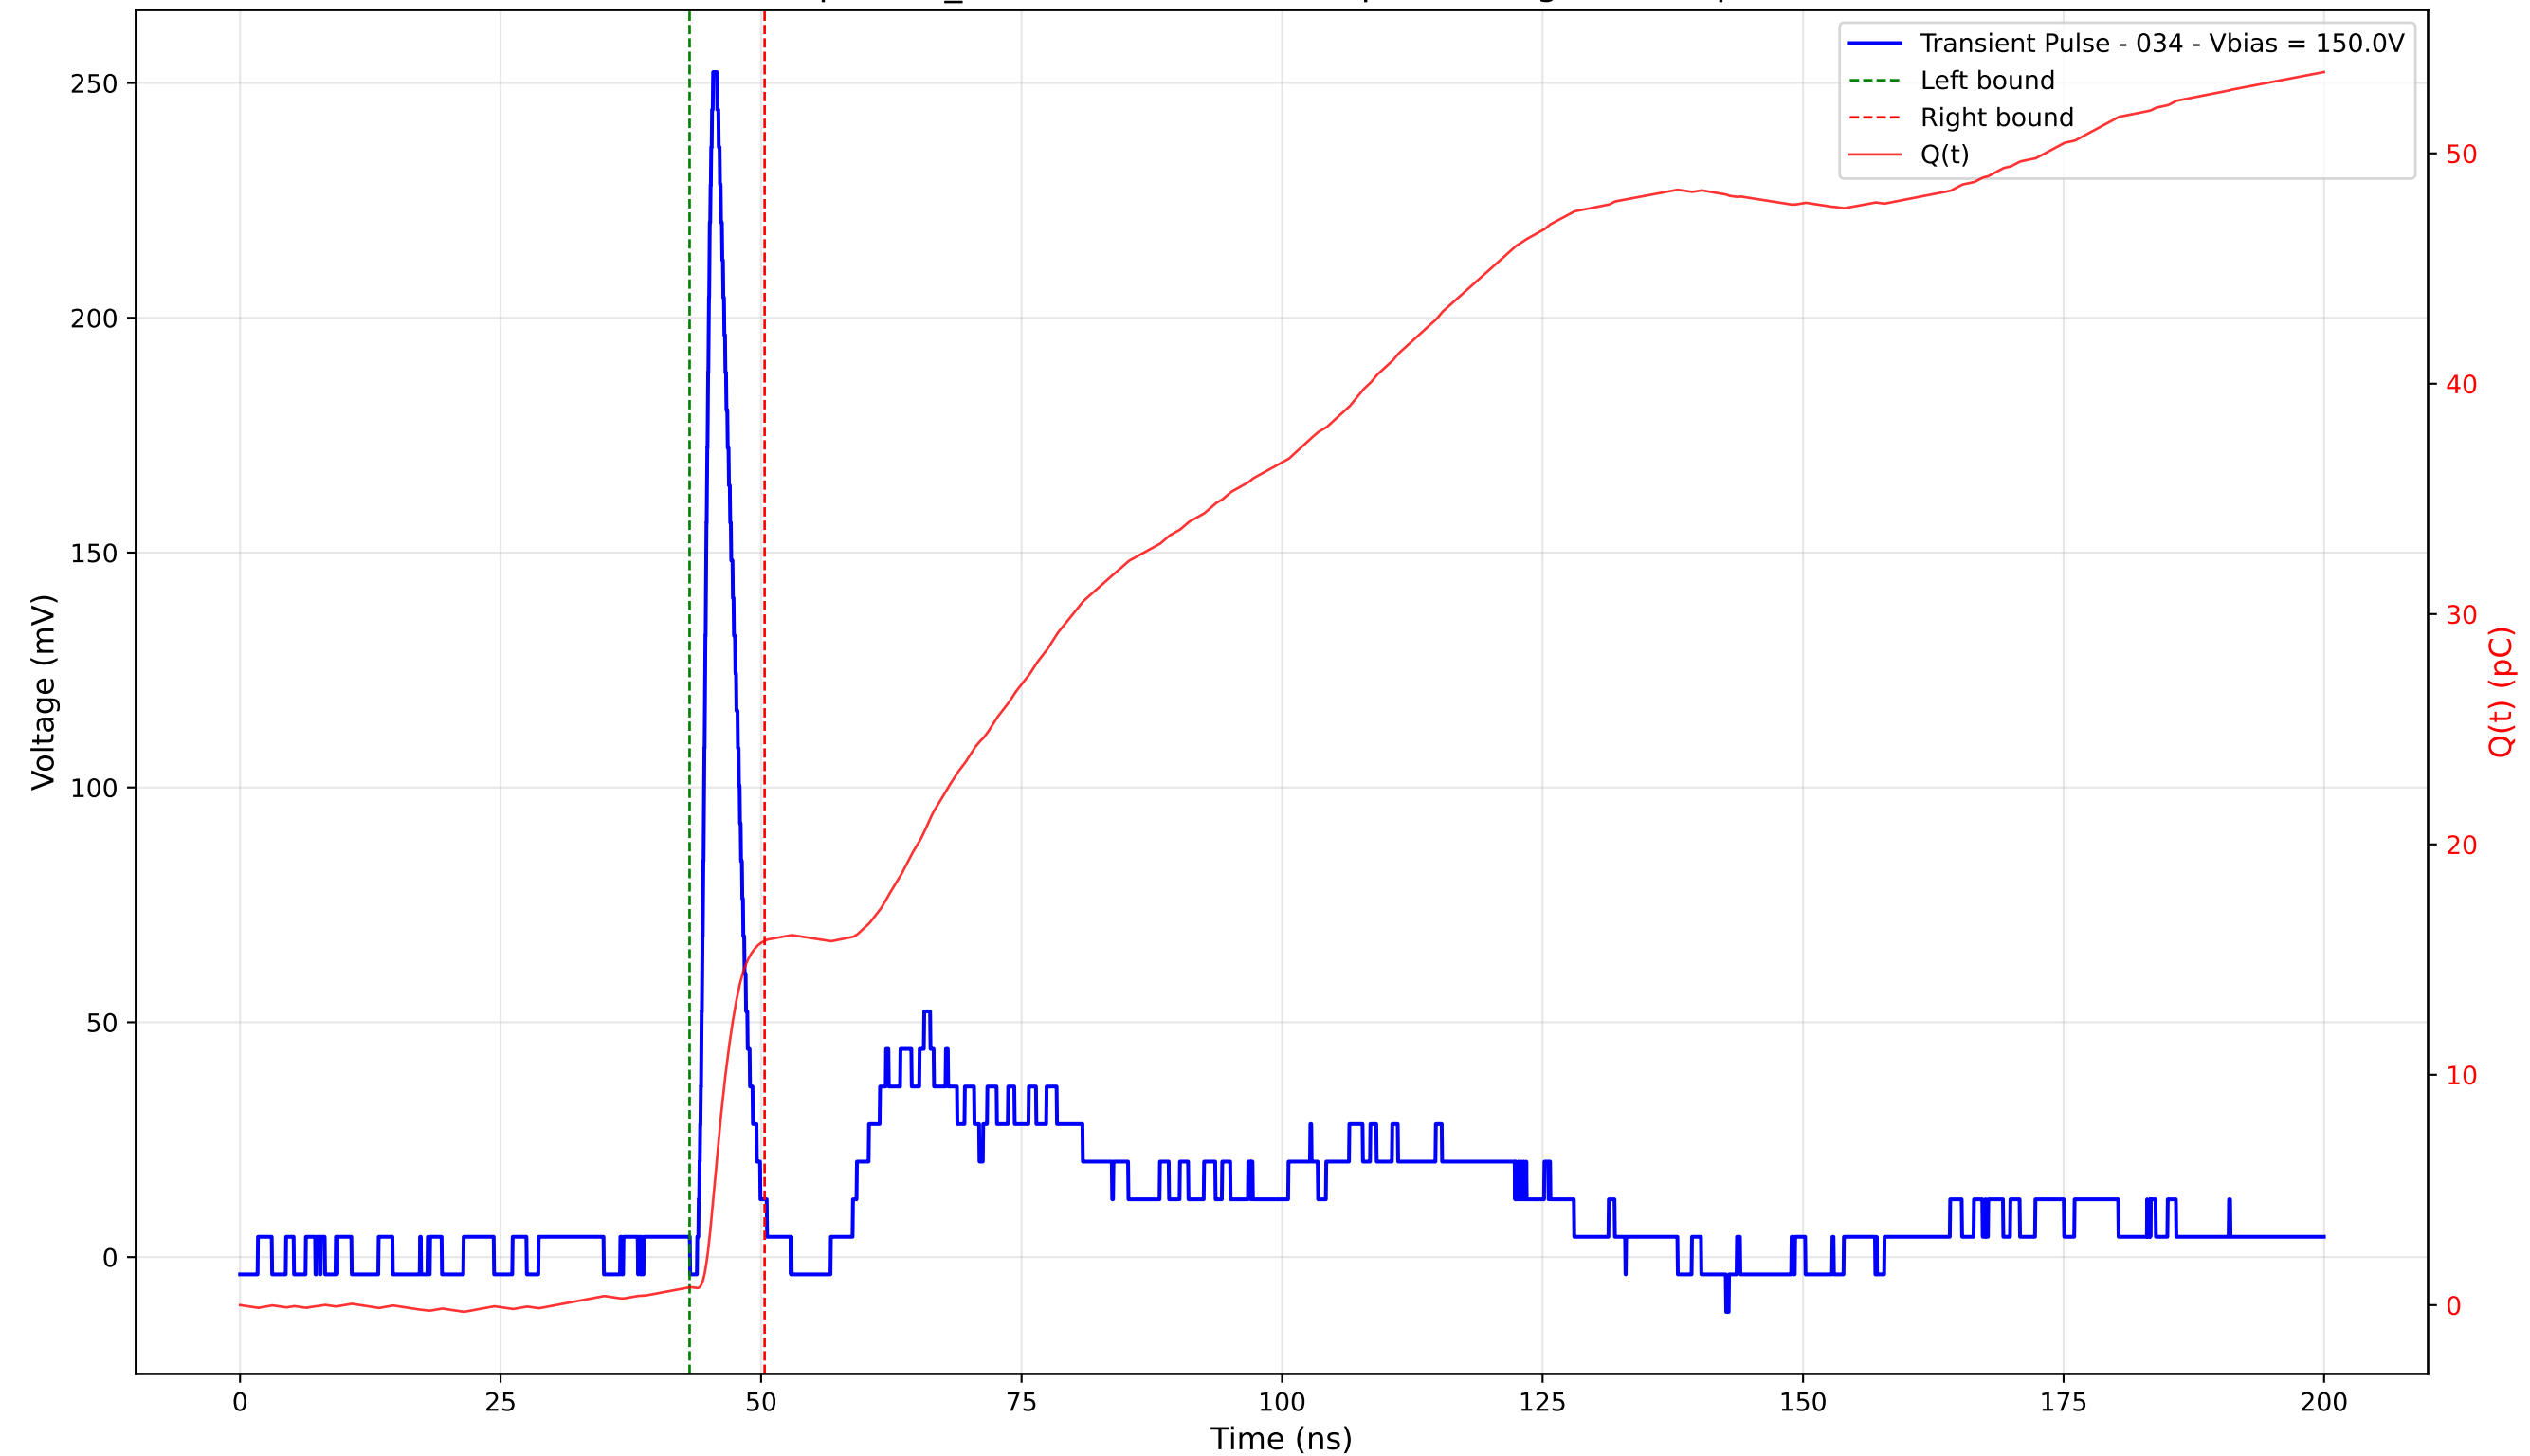


Transient Pulse - Sample: TD_4004 - Position: 395.0 μm - Charge: 12.52 pC - Rise Time: 1.03 ns

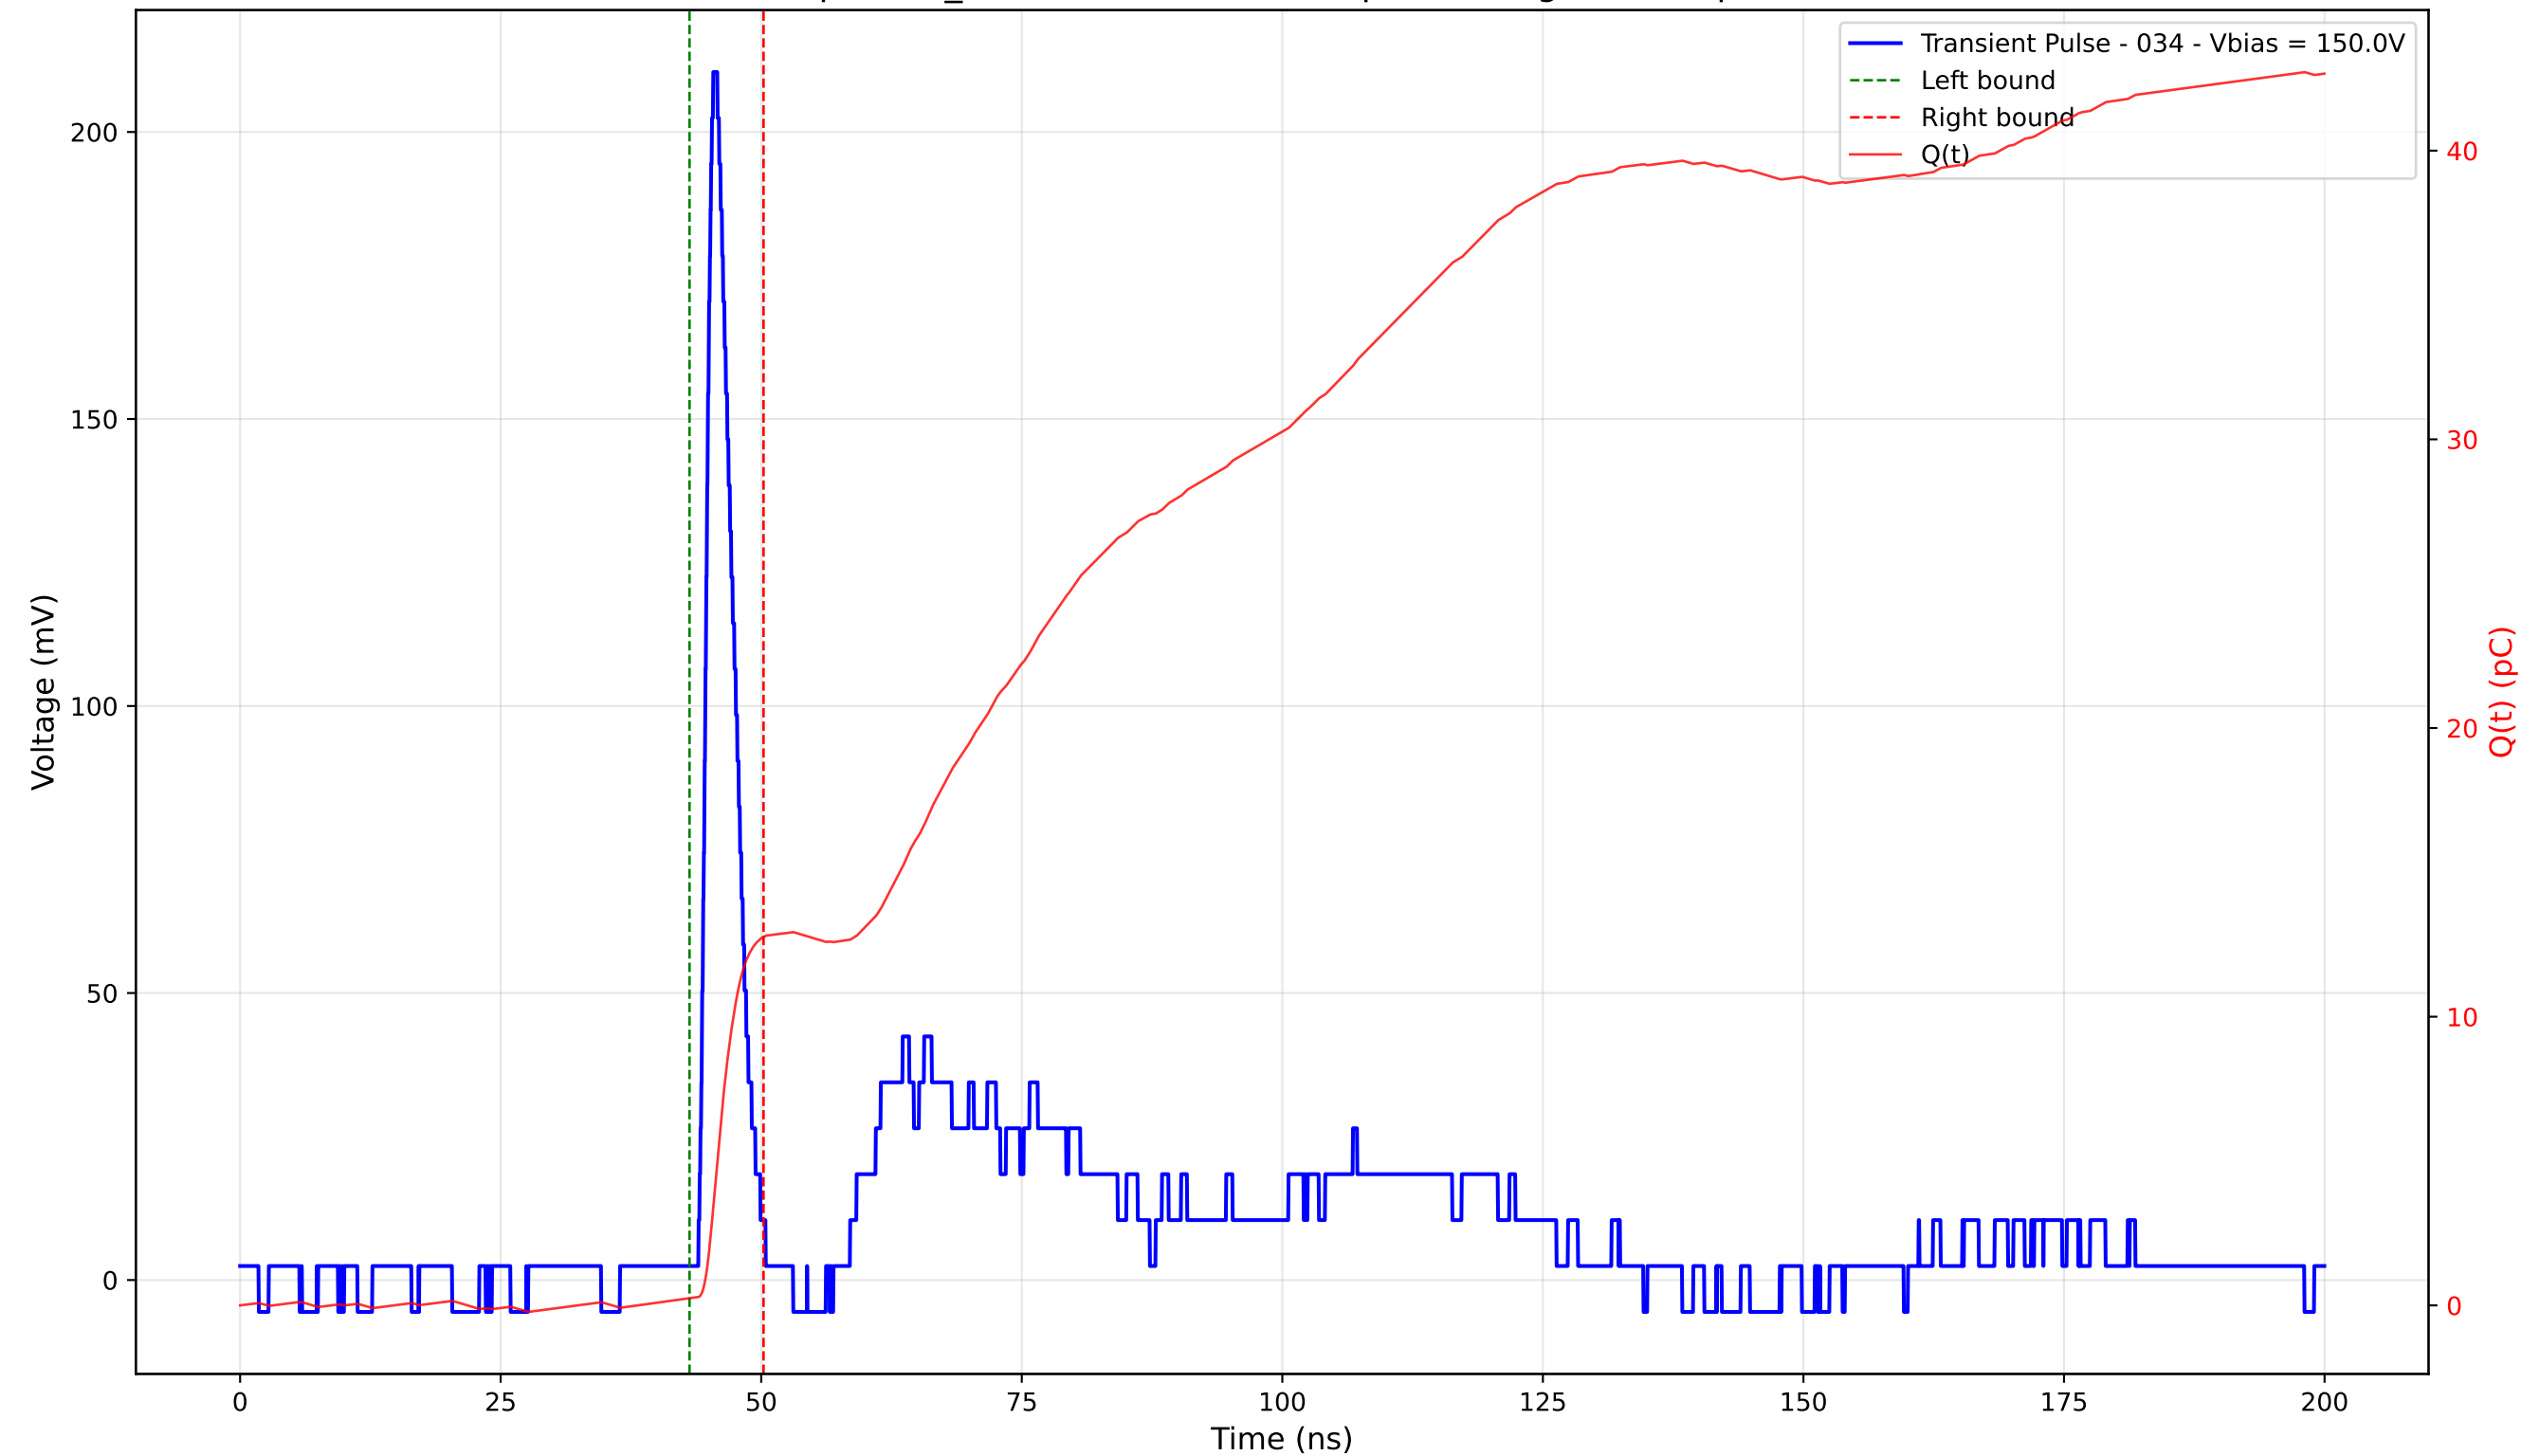


Transient Pulse - Sample: TD_4004 - Position: 400.0 μm - Charge: 10.03 pC - Rise Time: 1.07 ns

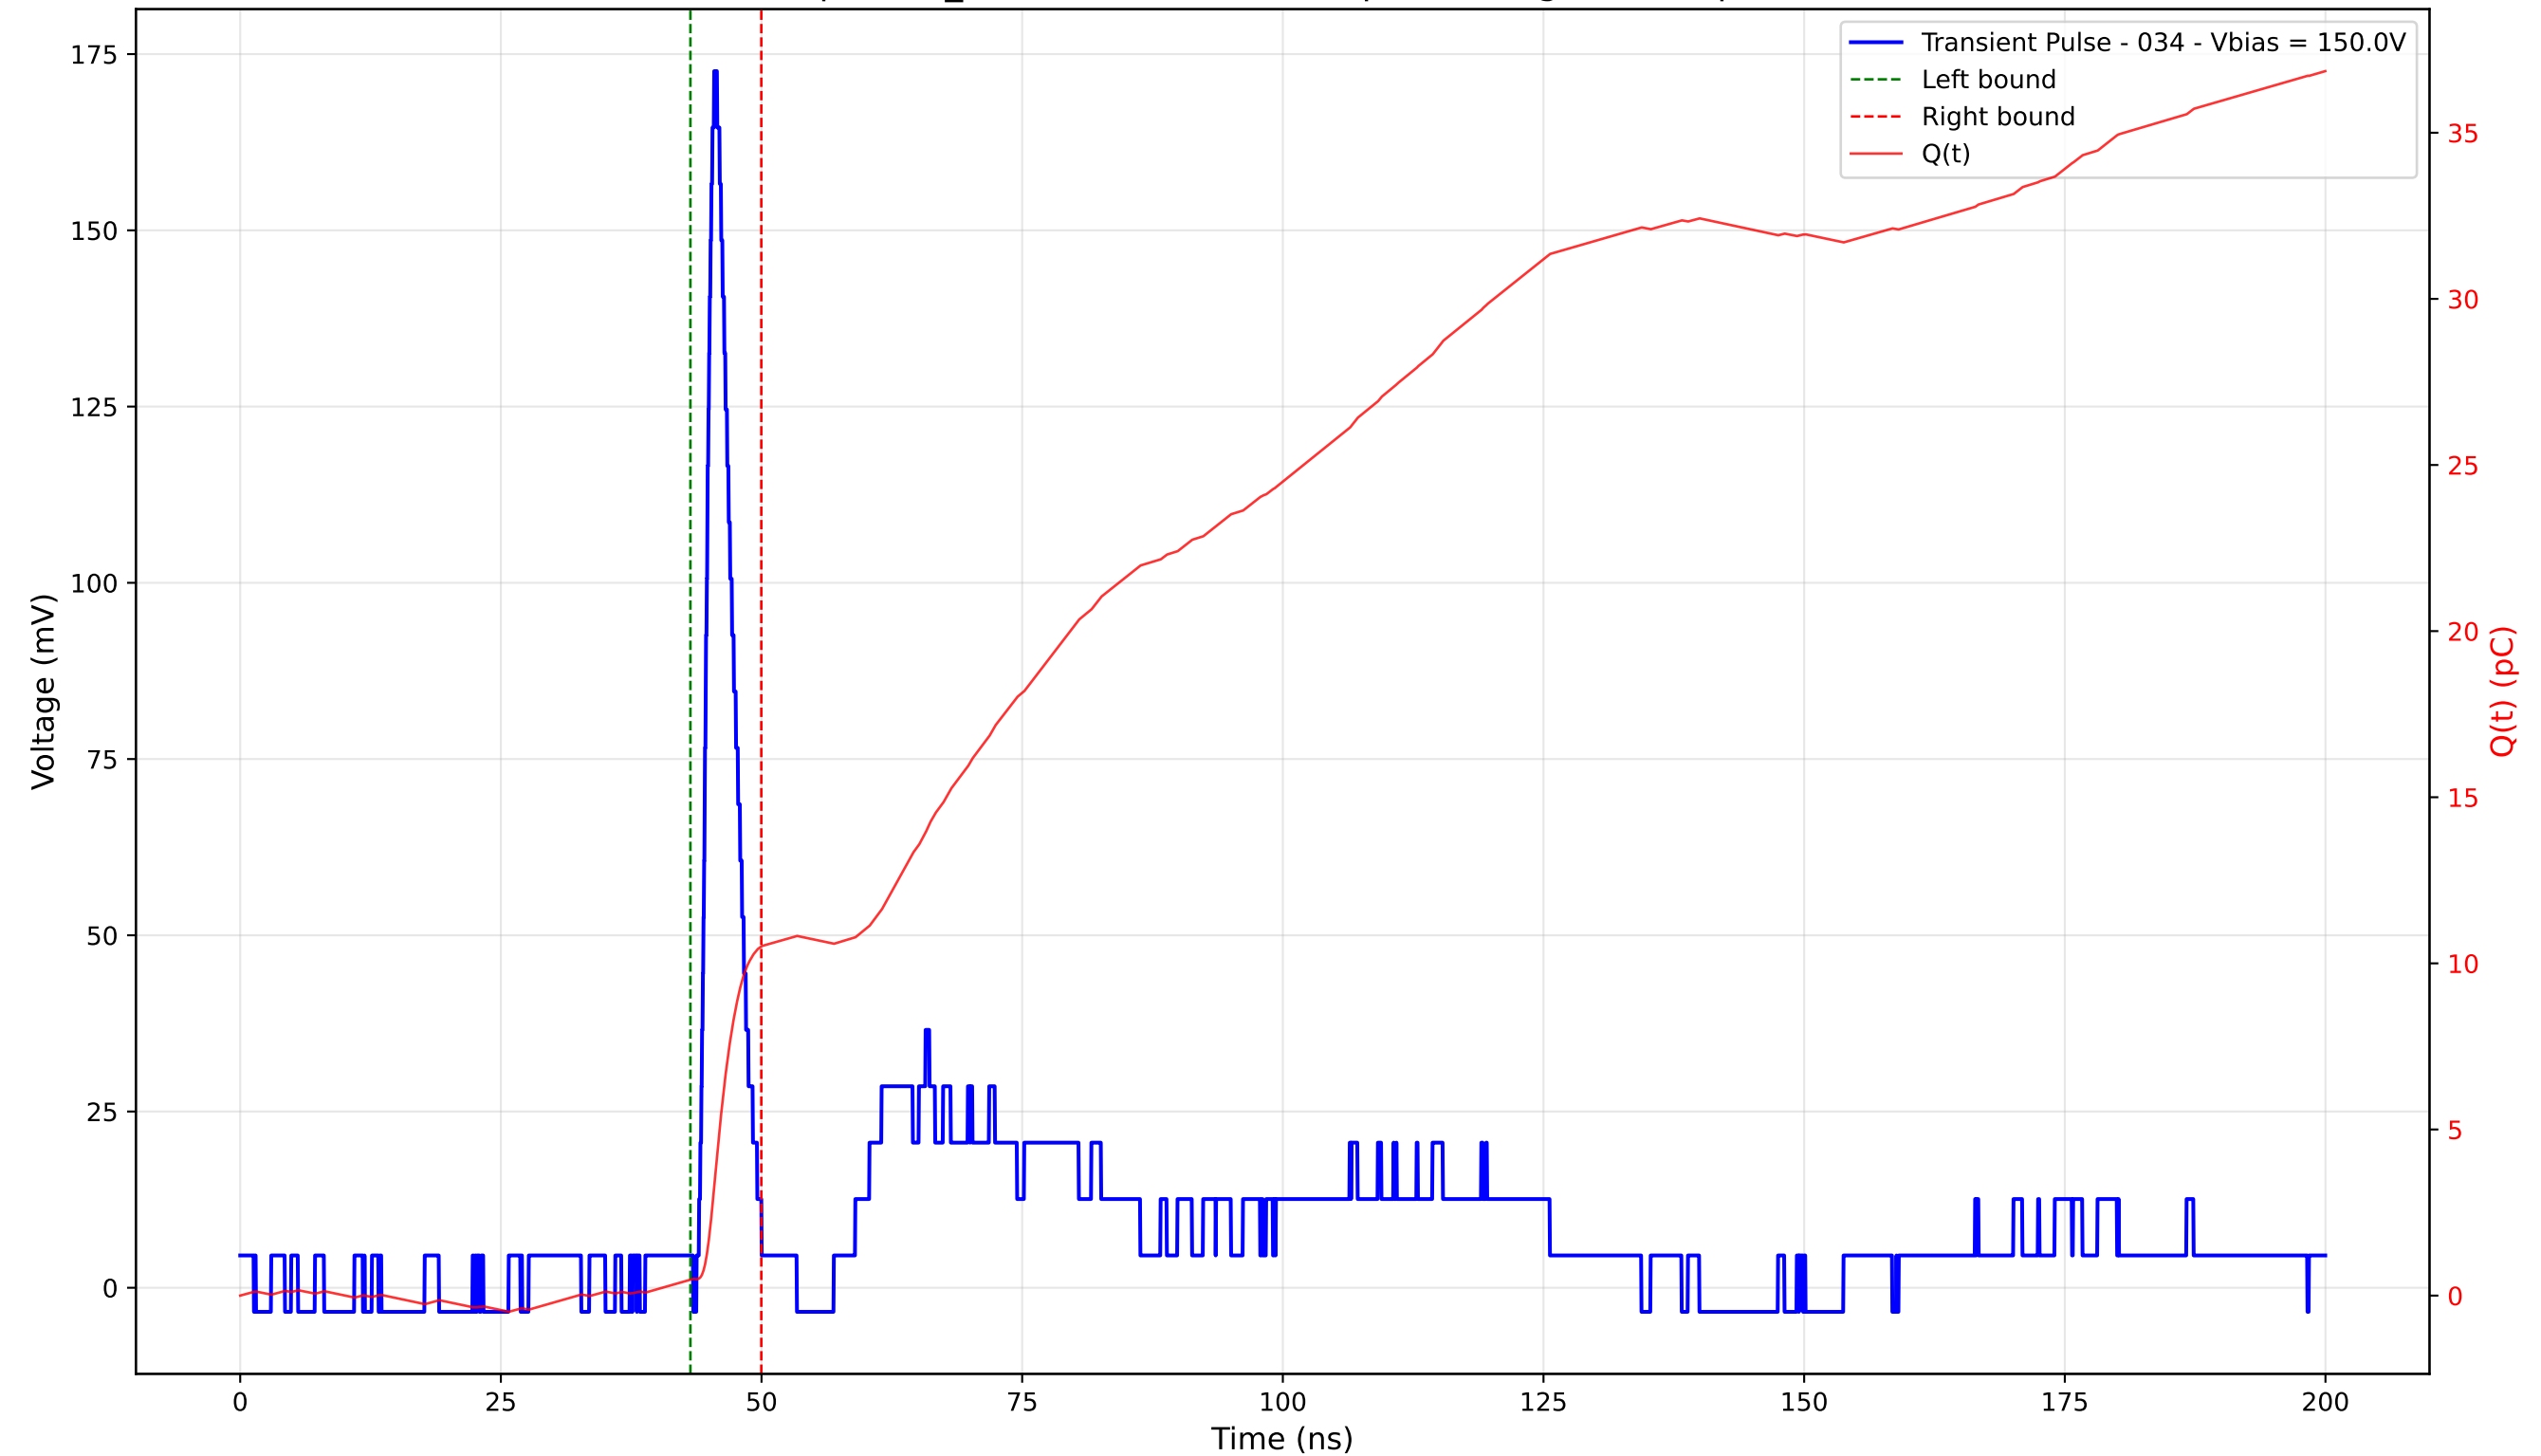


Transient Pulse - Sample: TD_4004 - Position: 405.0 μm - Charge: 8.31 pC - Rise Time: 1.11 ns

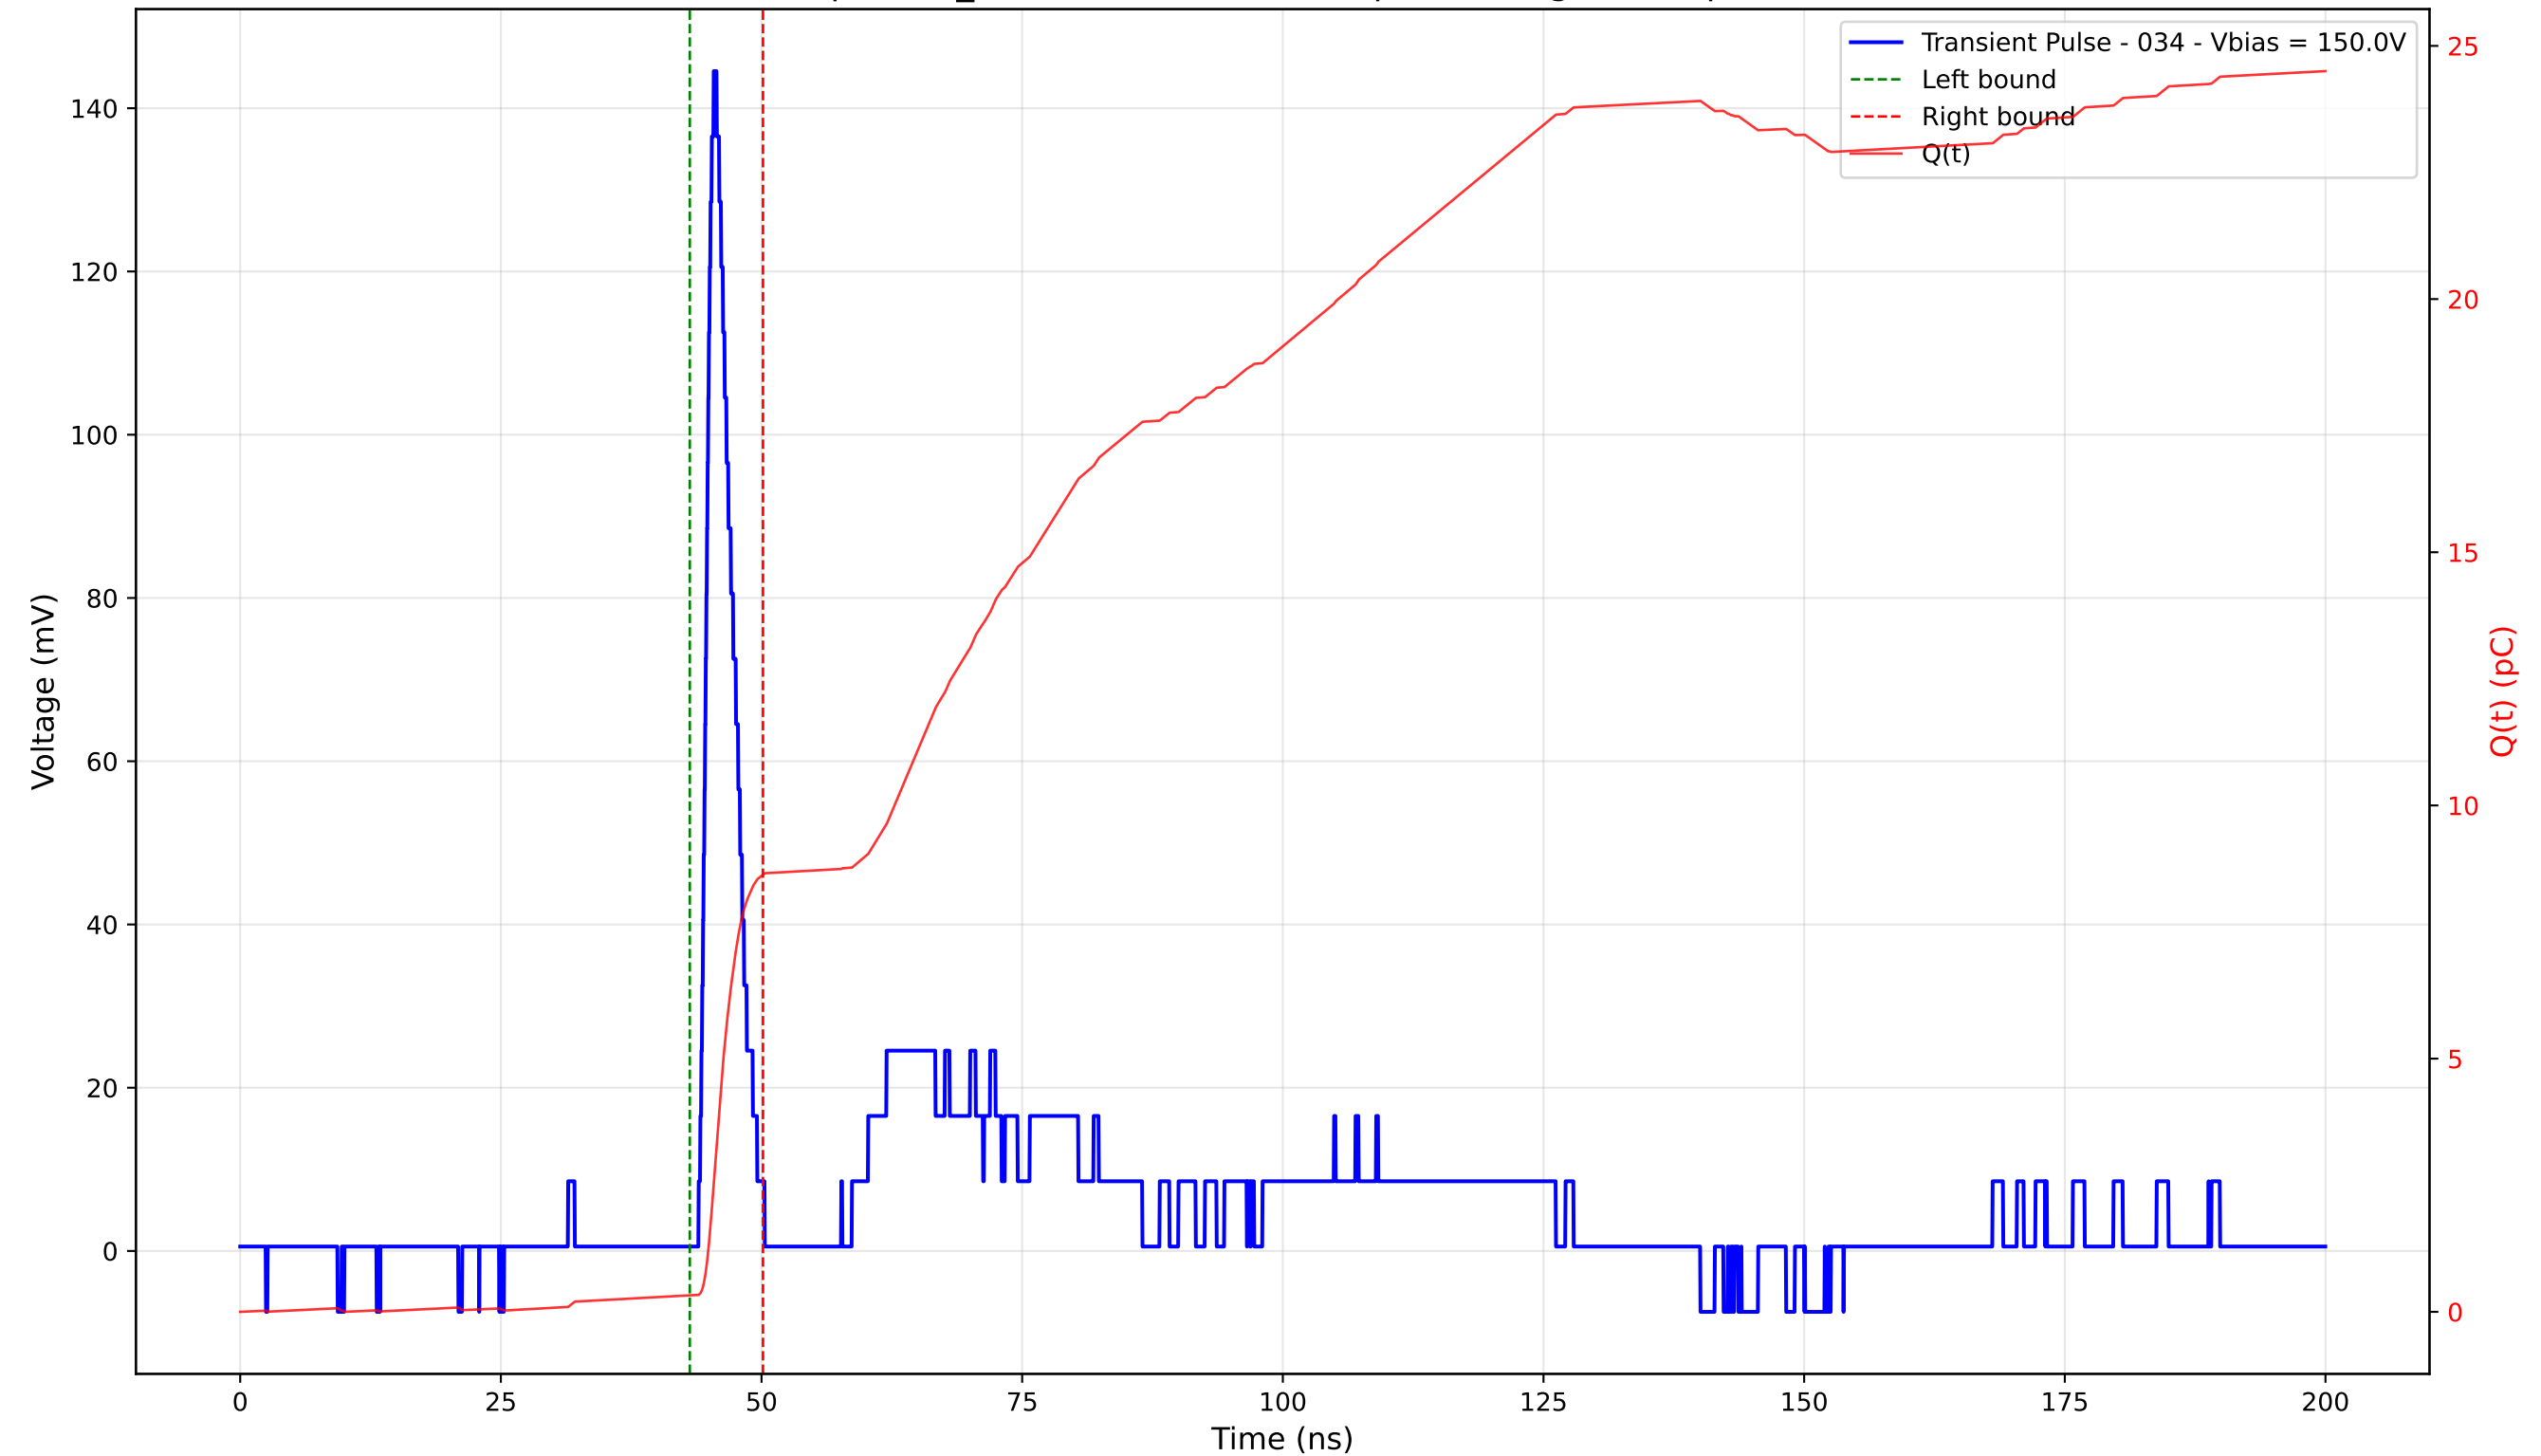


Transient Pulse - Sample: TD_4004 - Position: 410.0 μm - Charge: 6.92 pC - Rise Time: 1.03 ns

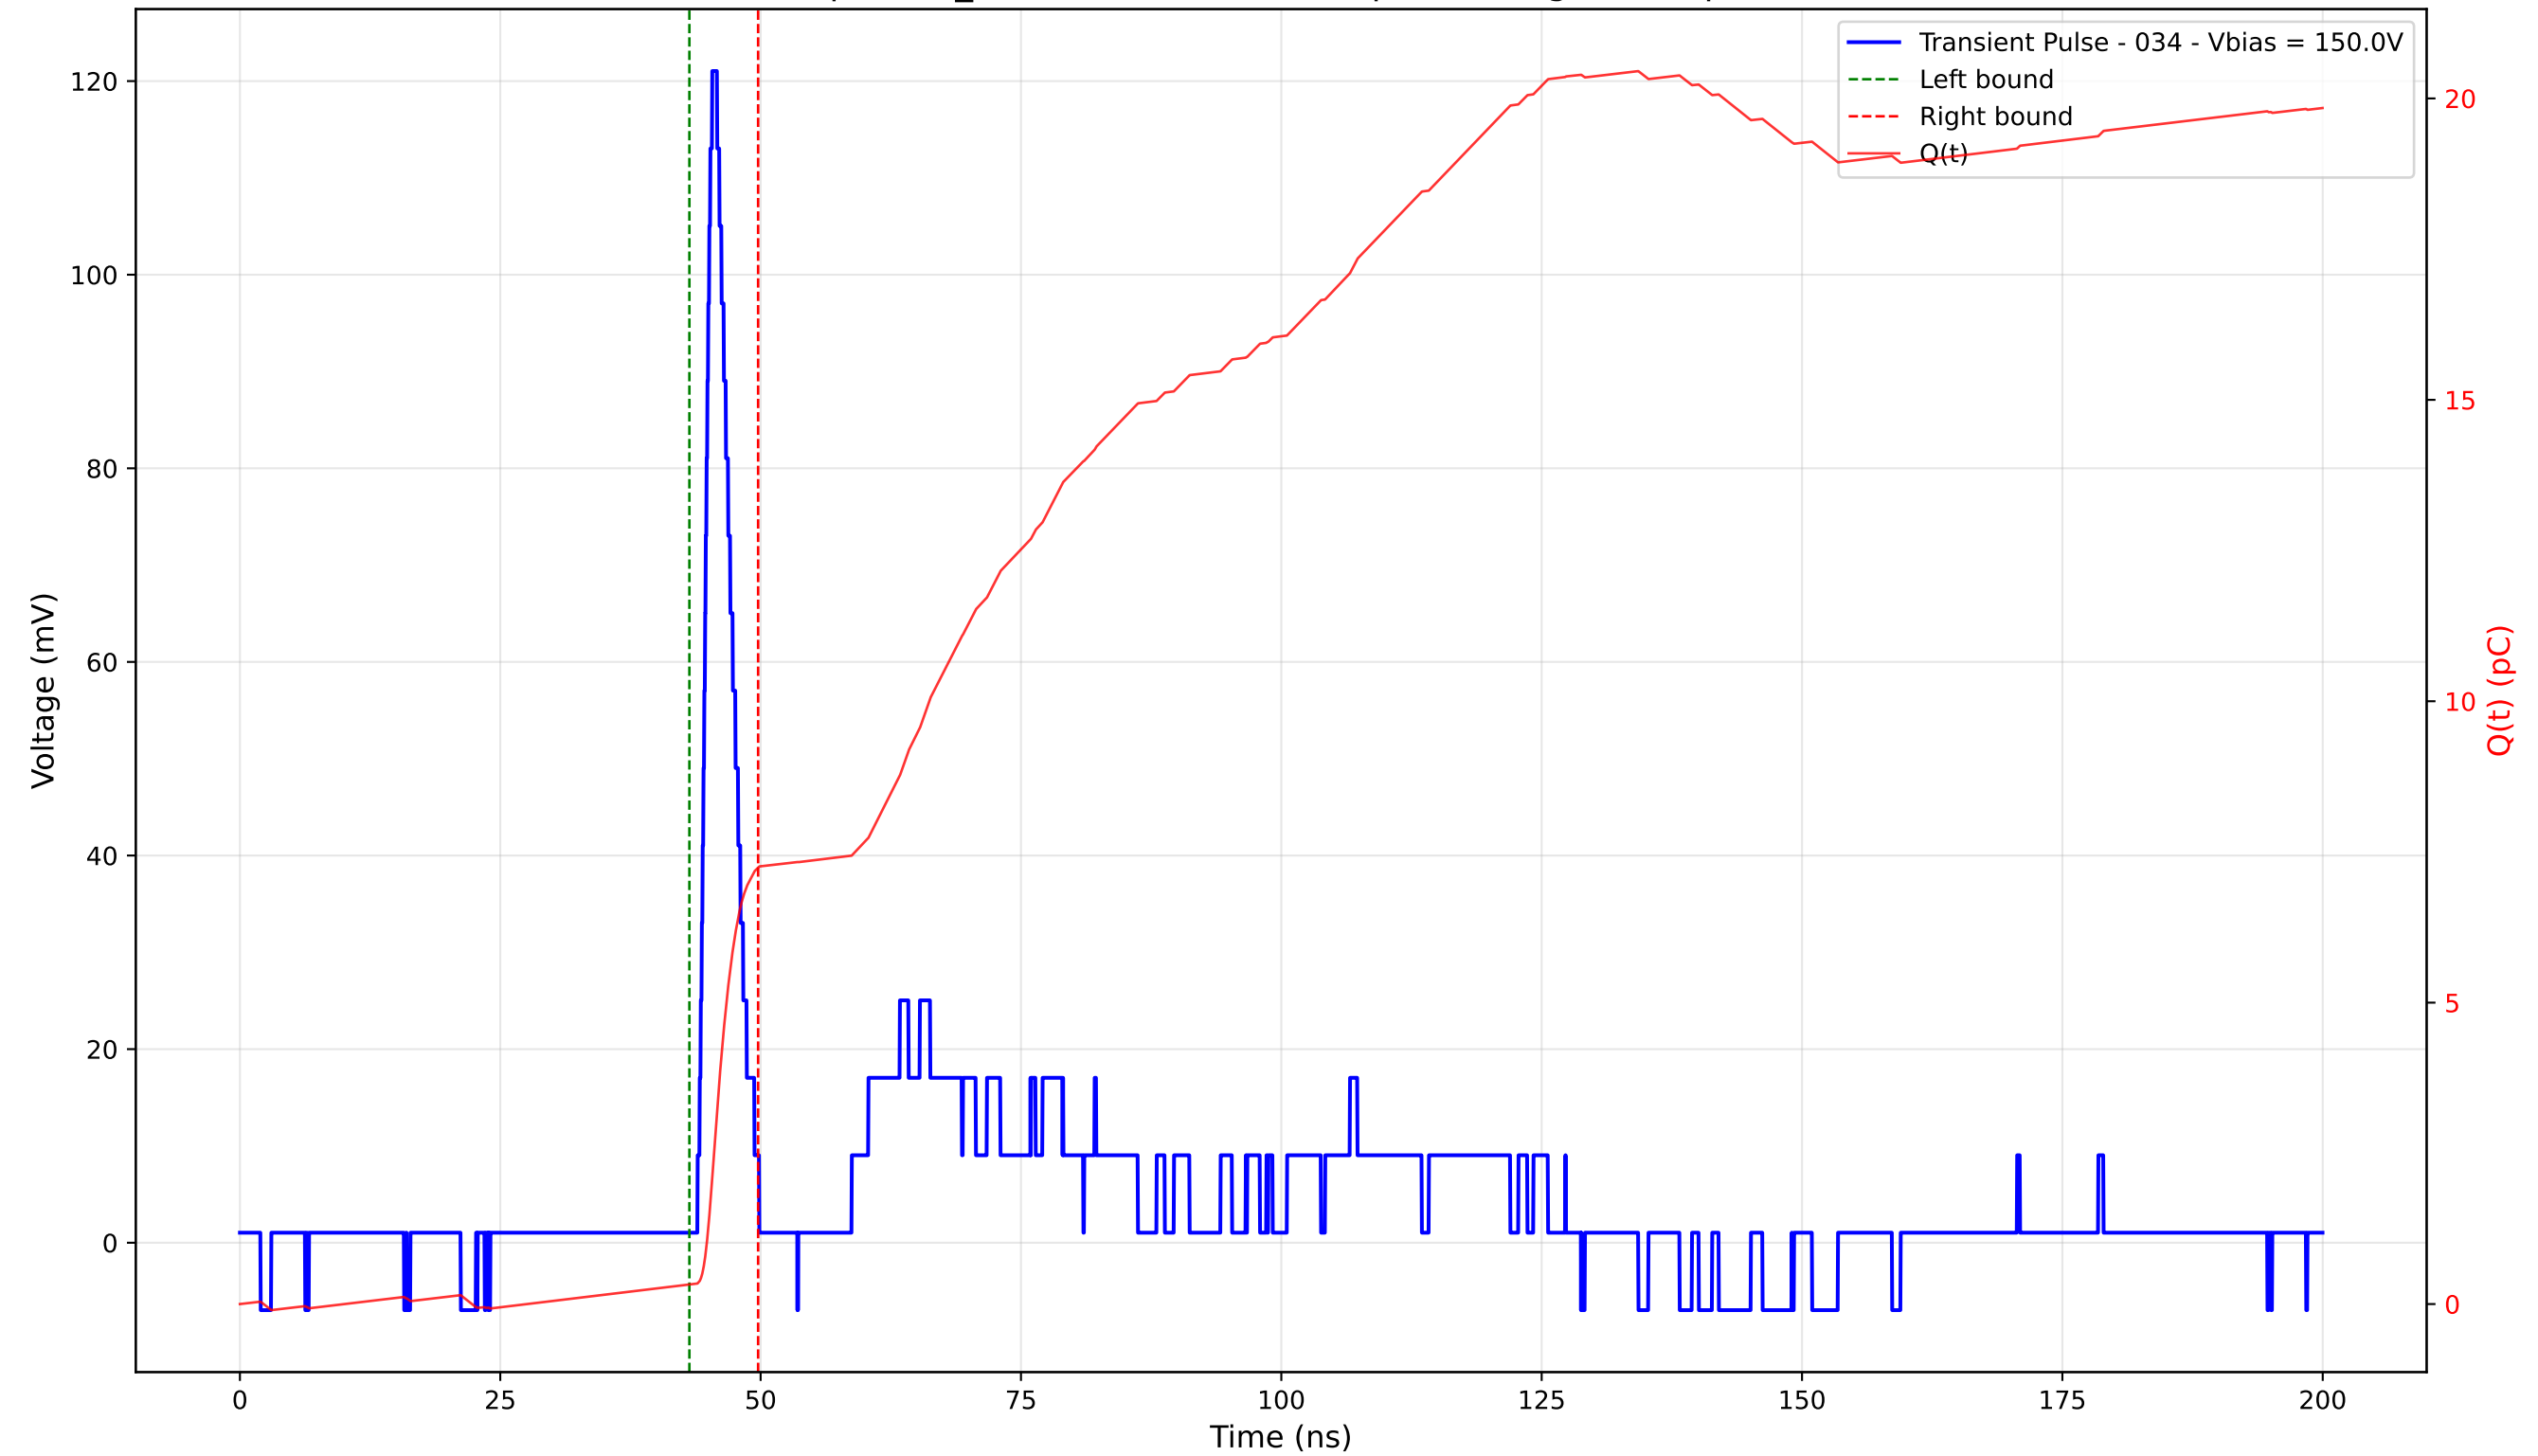


Transient Pulse - Sample: TD_4004 - Position: 415.0 μm - Charge: 4.96 pC - Rise Time: 0.92 ns

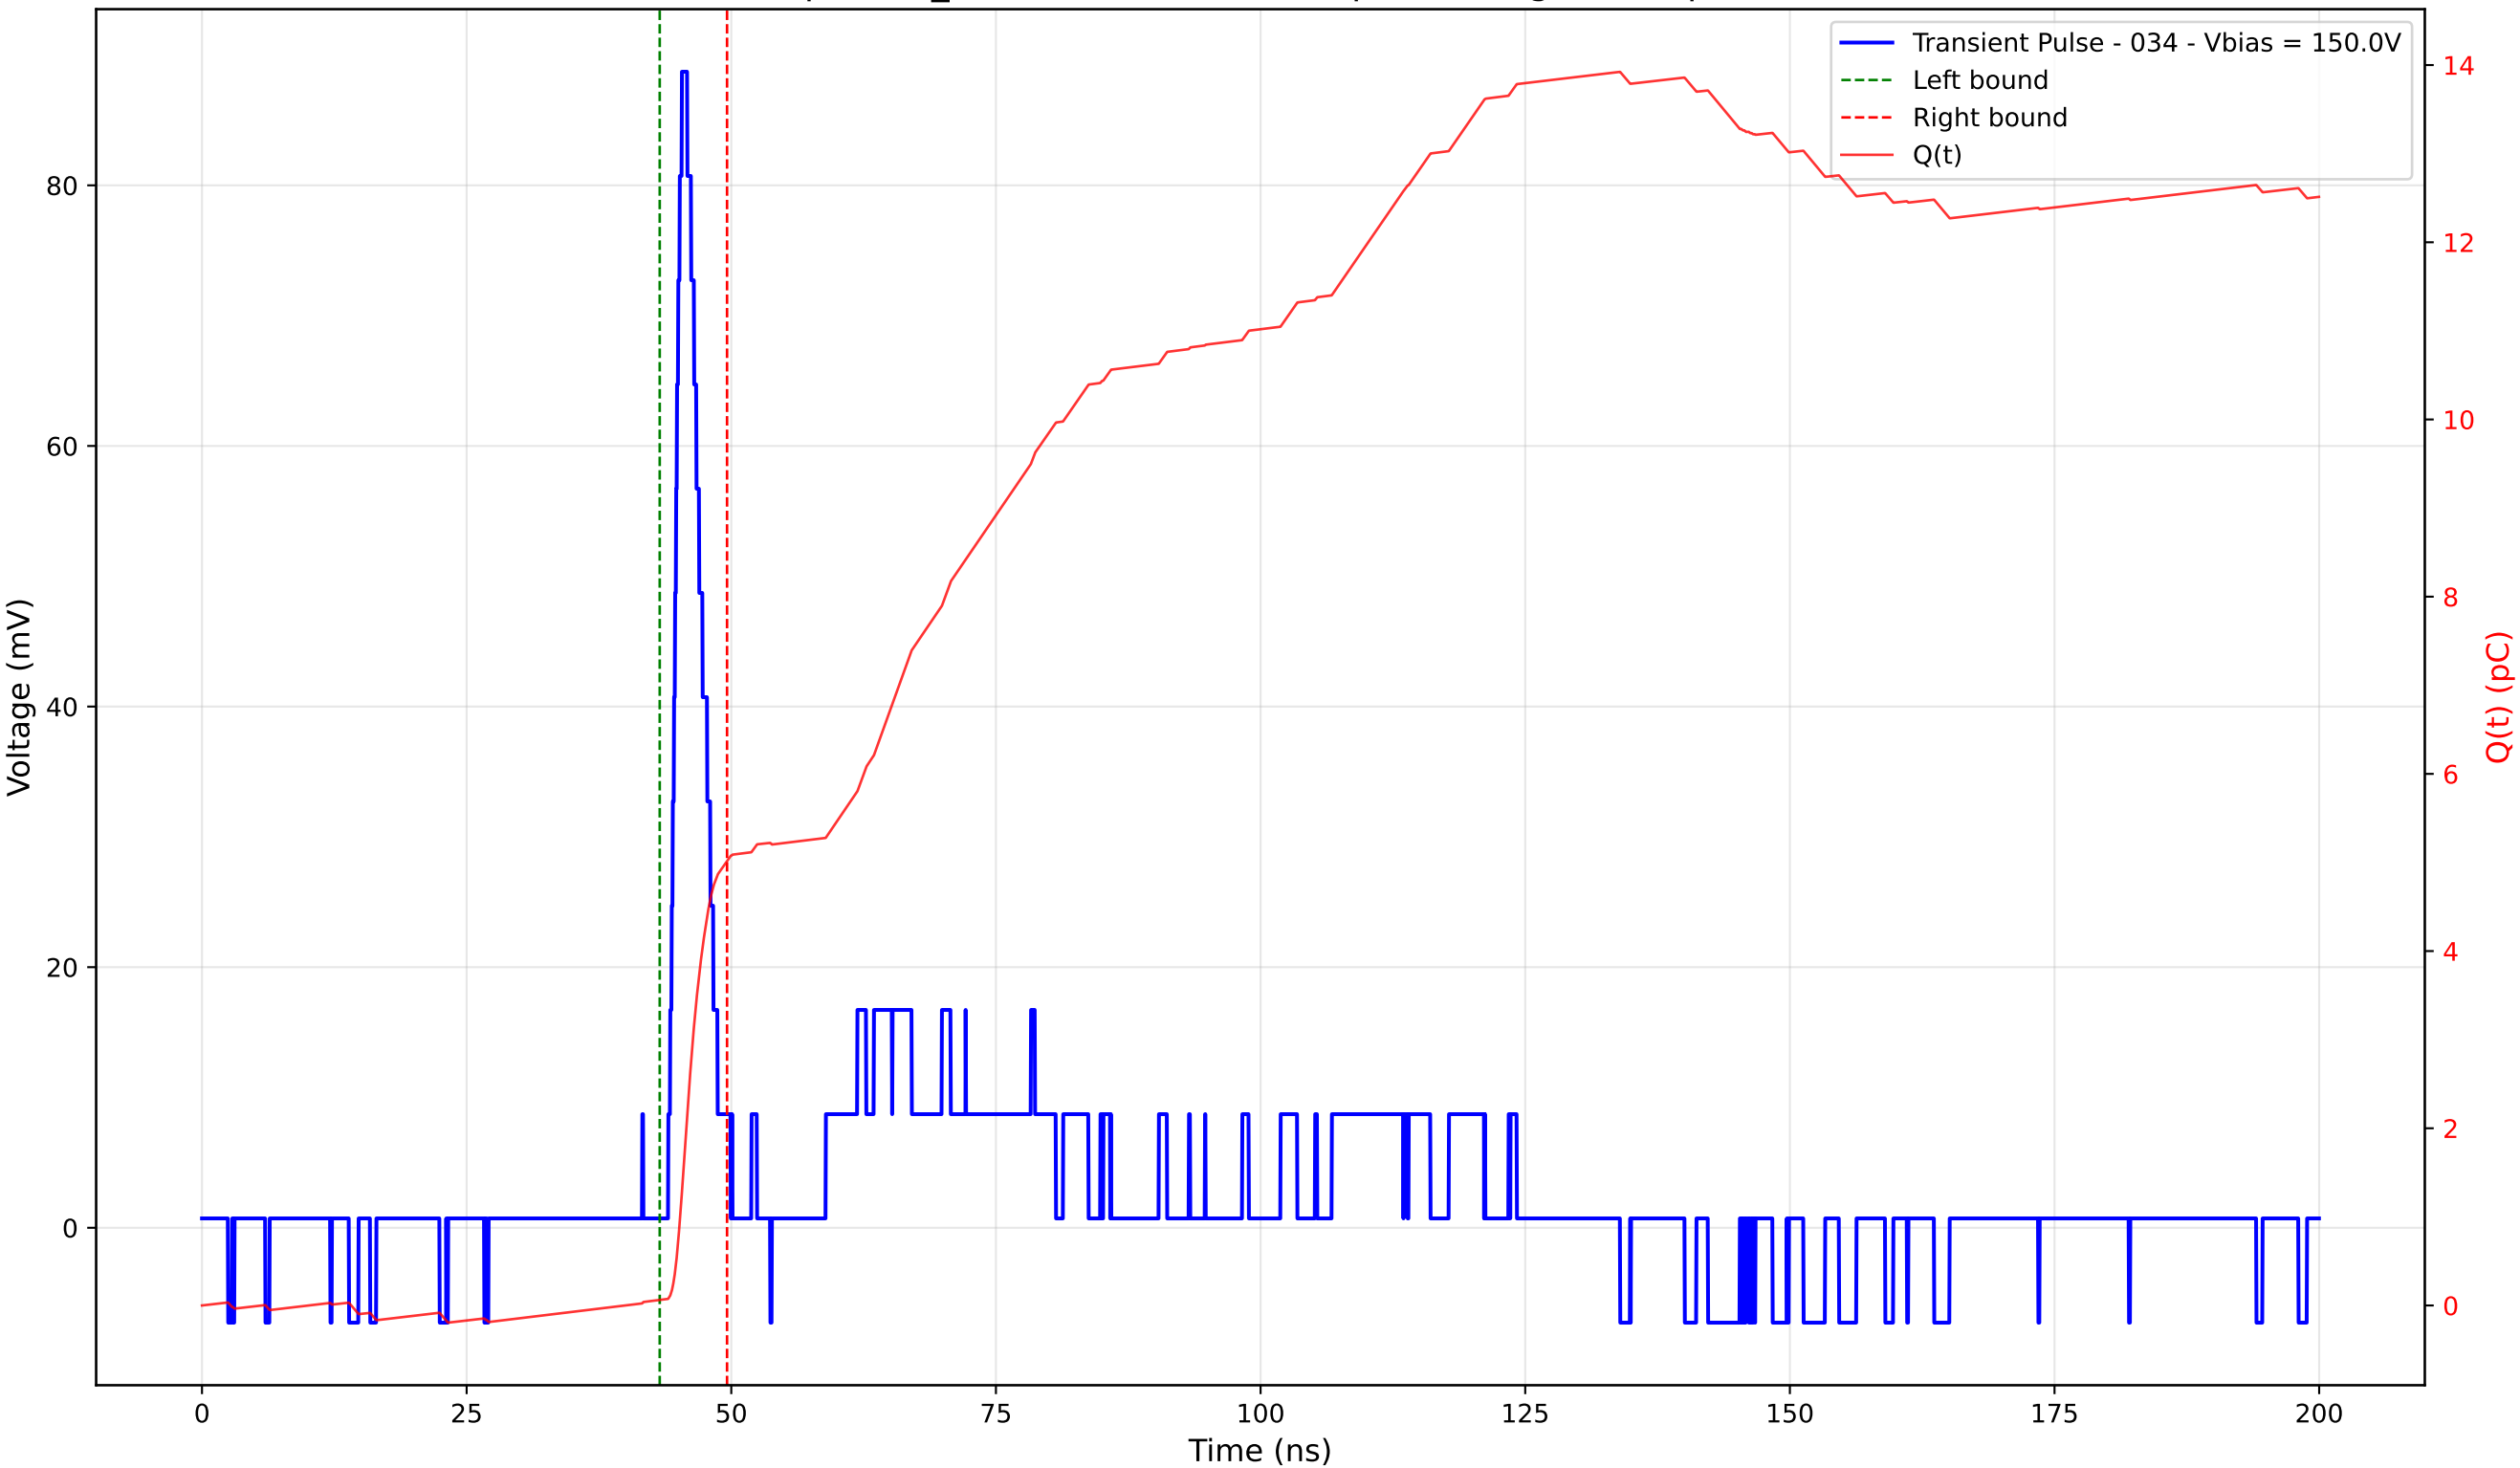


Transient Pulse - Sample: TD_4004 - Position: 420.0 μm - Charge: 3.44 pC - Rise Time: 1.15 ns

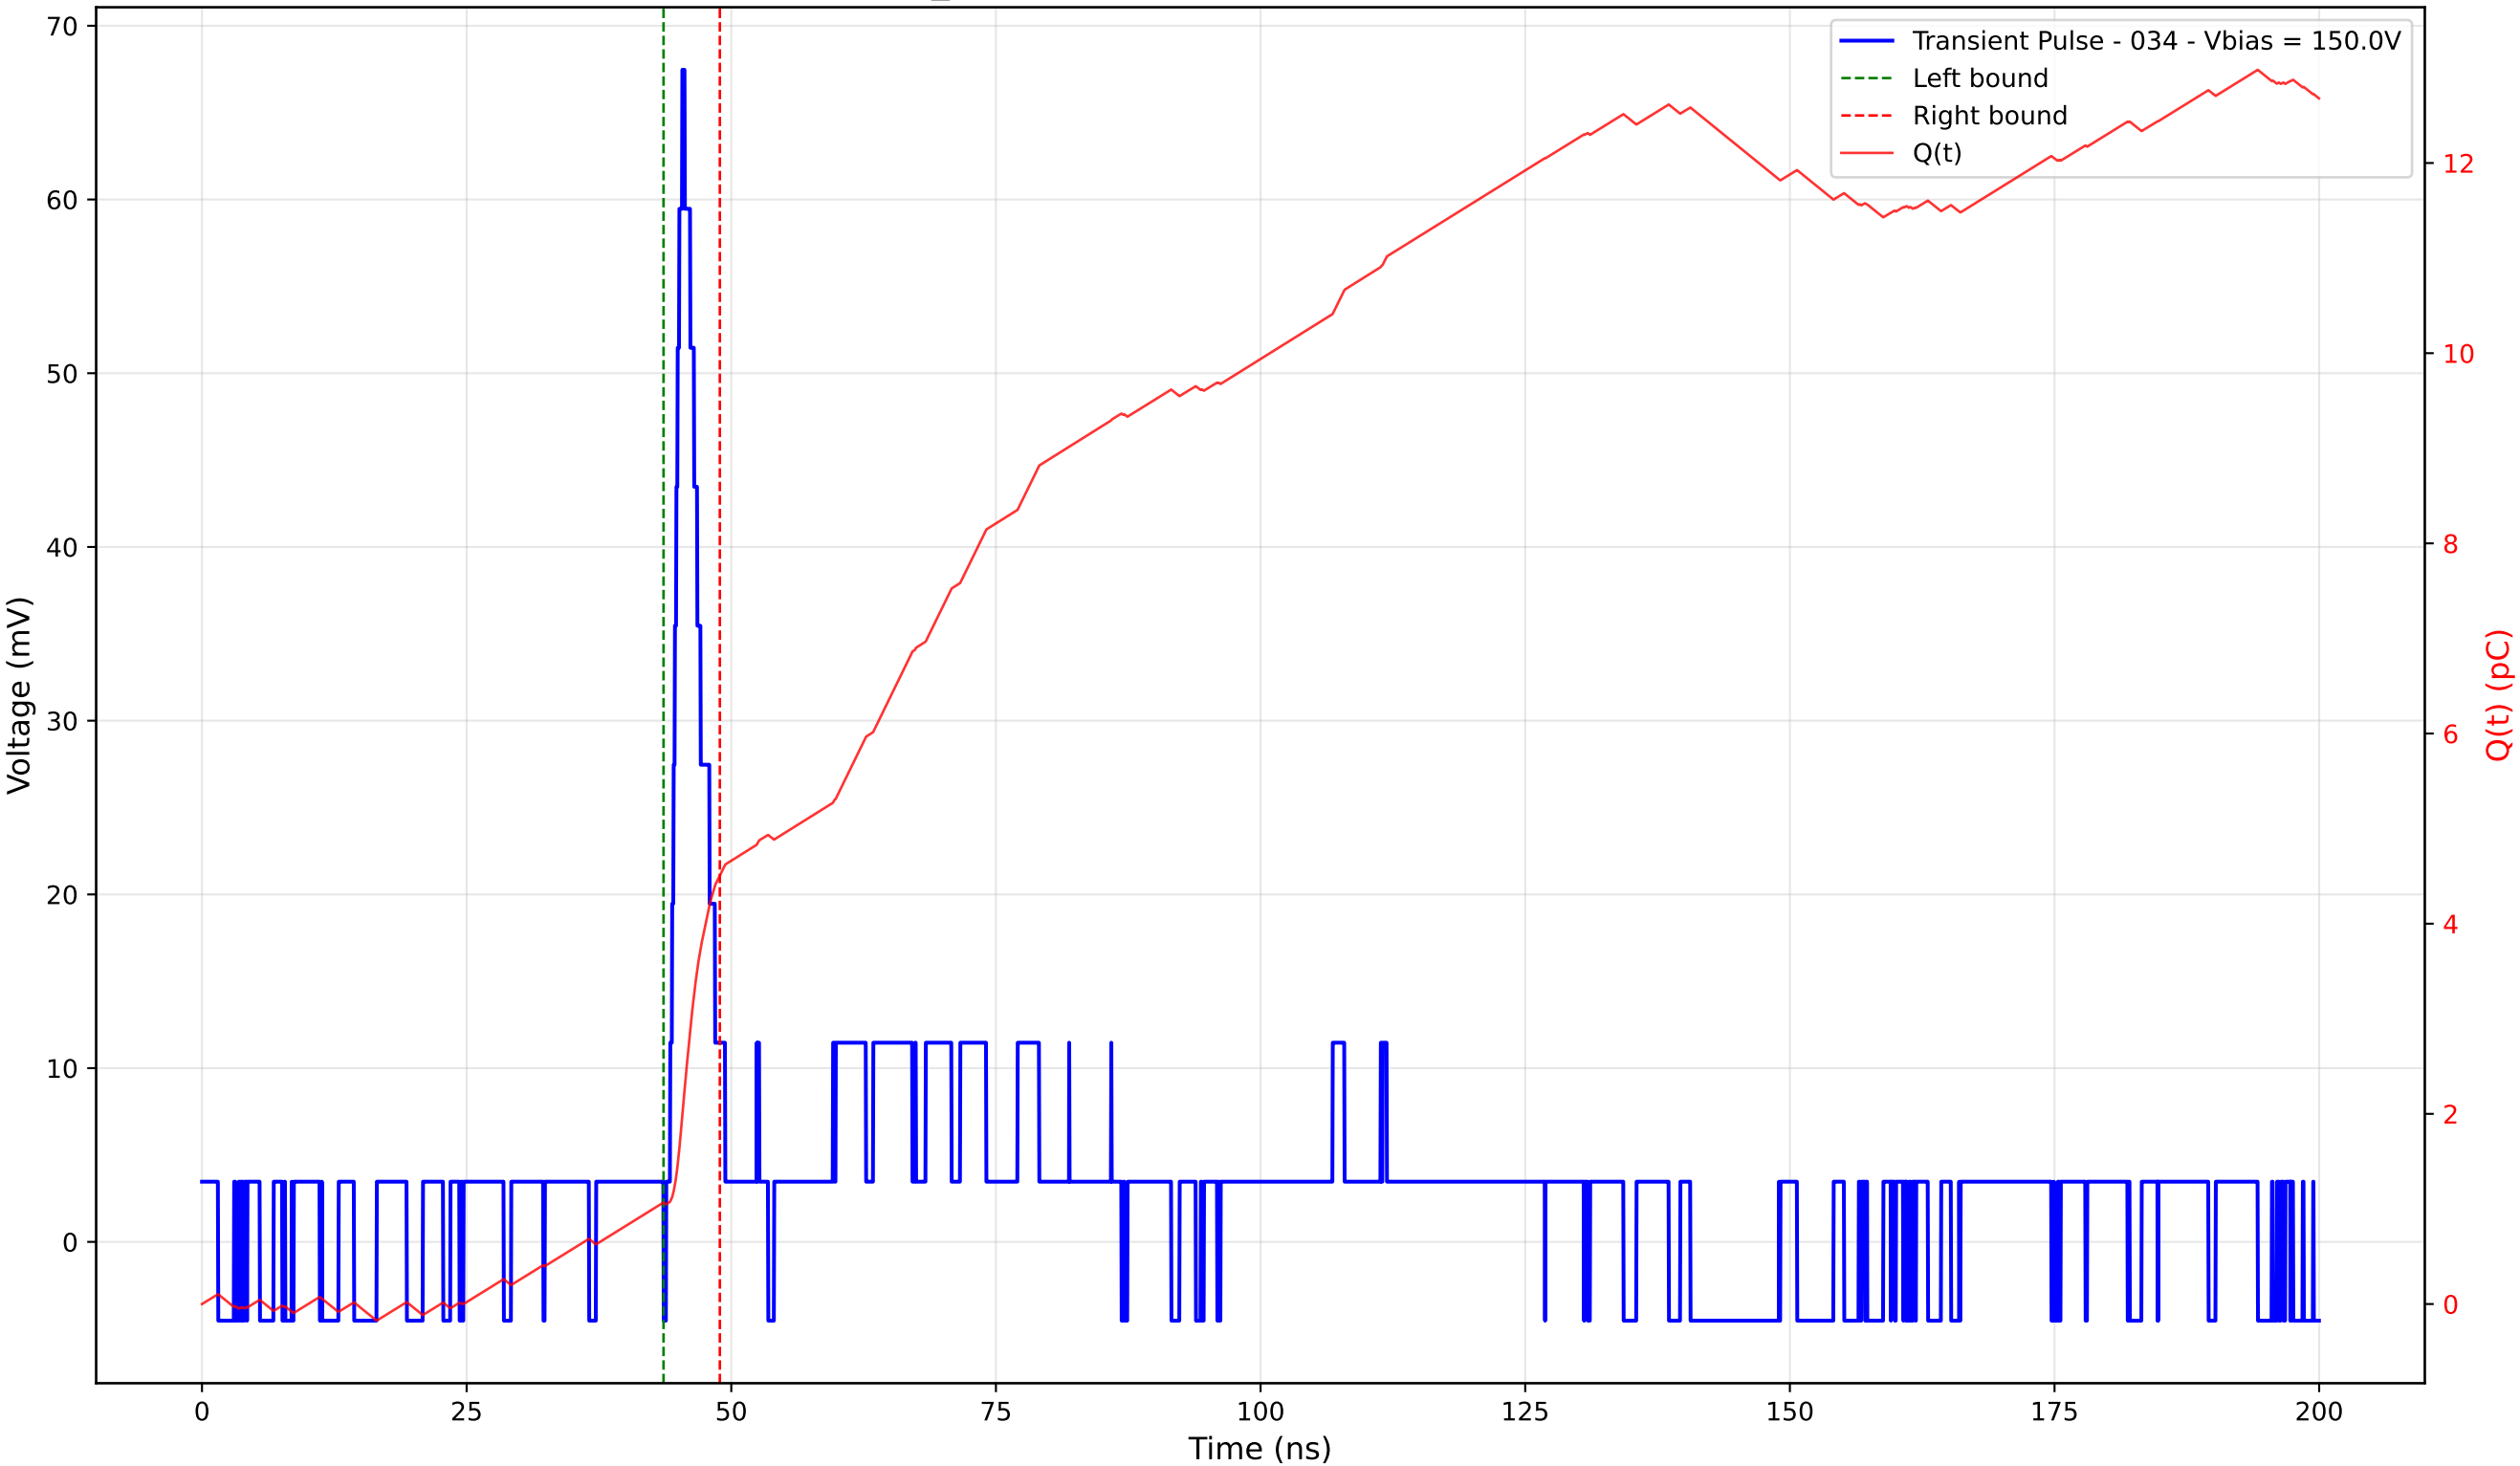

Transient Pulse - Sample: TD_4004 - Position: 425.0 μm - Charge: 2.70 pC - Rise Time: 1.03 ns

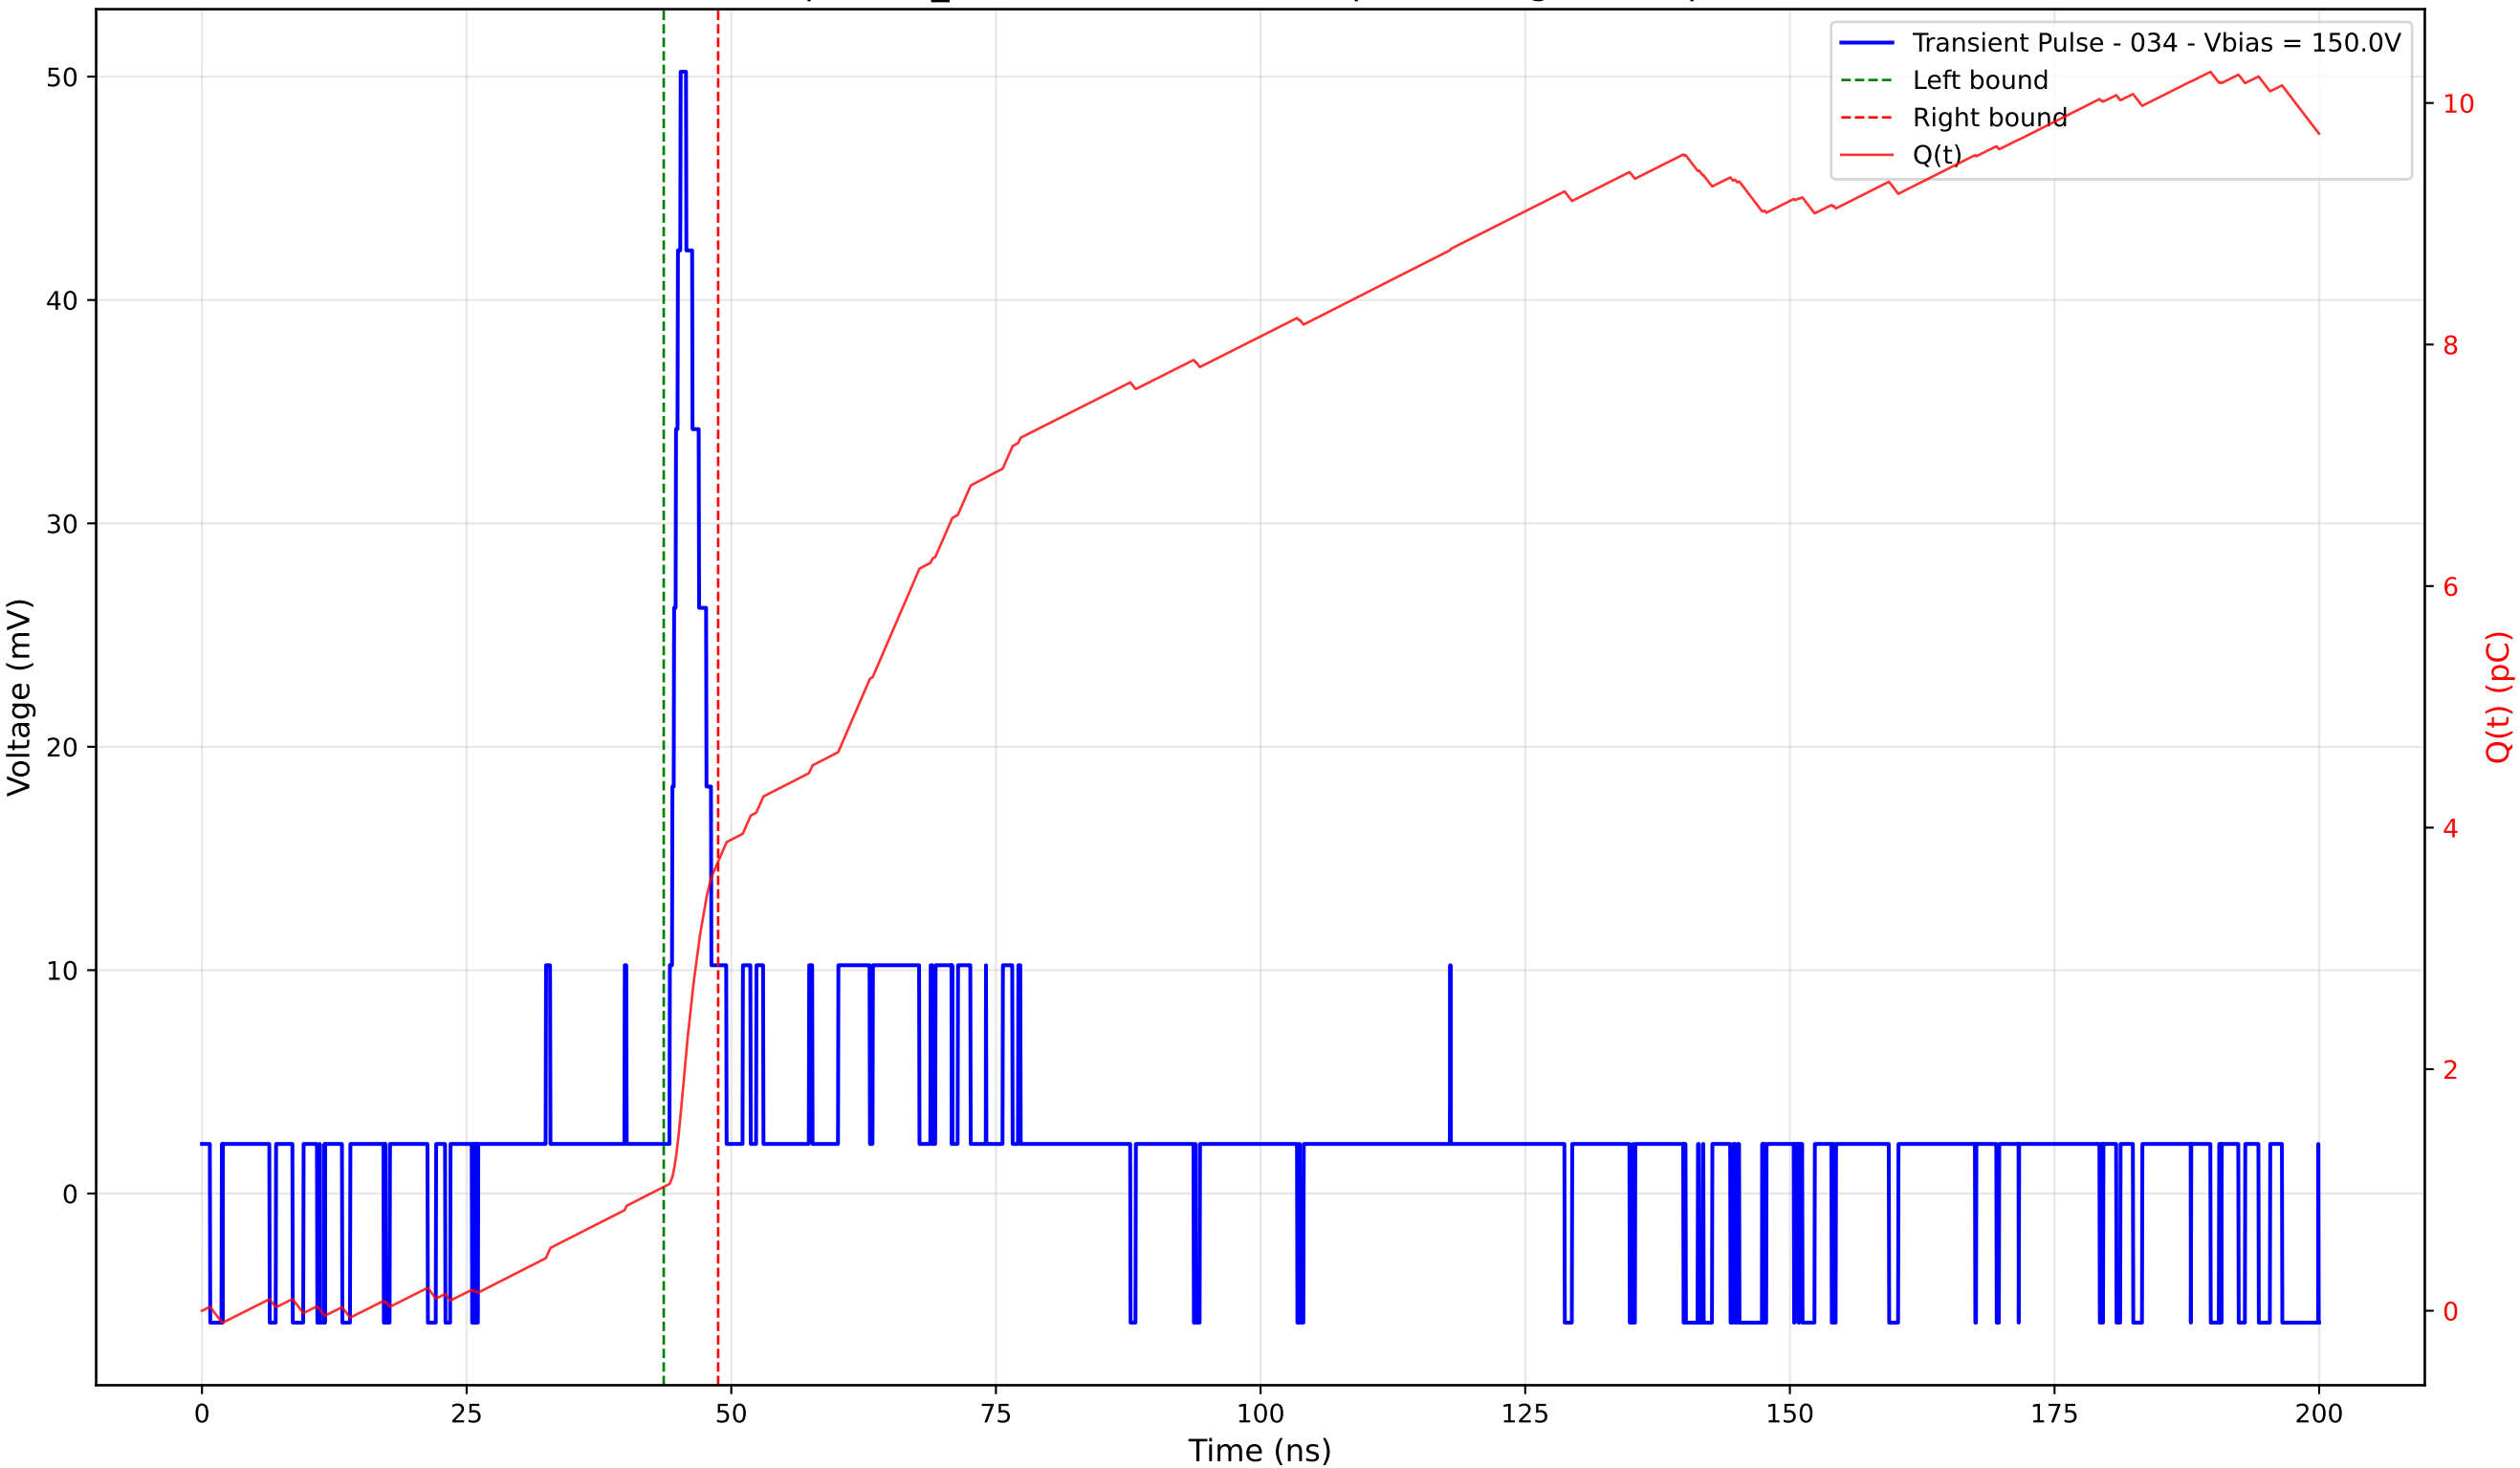

Transient Pulse - Sample: TD_4004 - Position: 430.0 μm - Charge: 2.30 pC - Rise Time: 0.84 ns

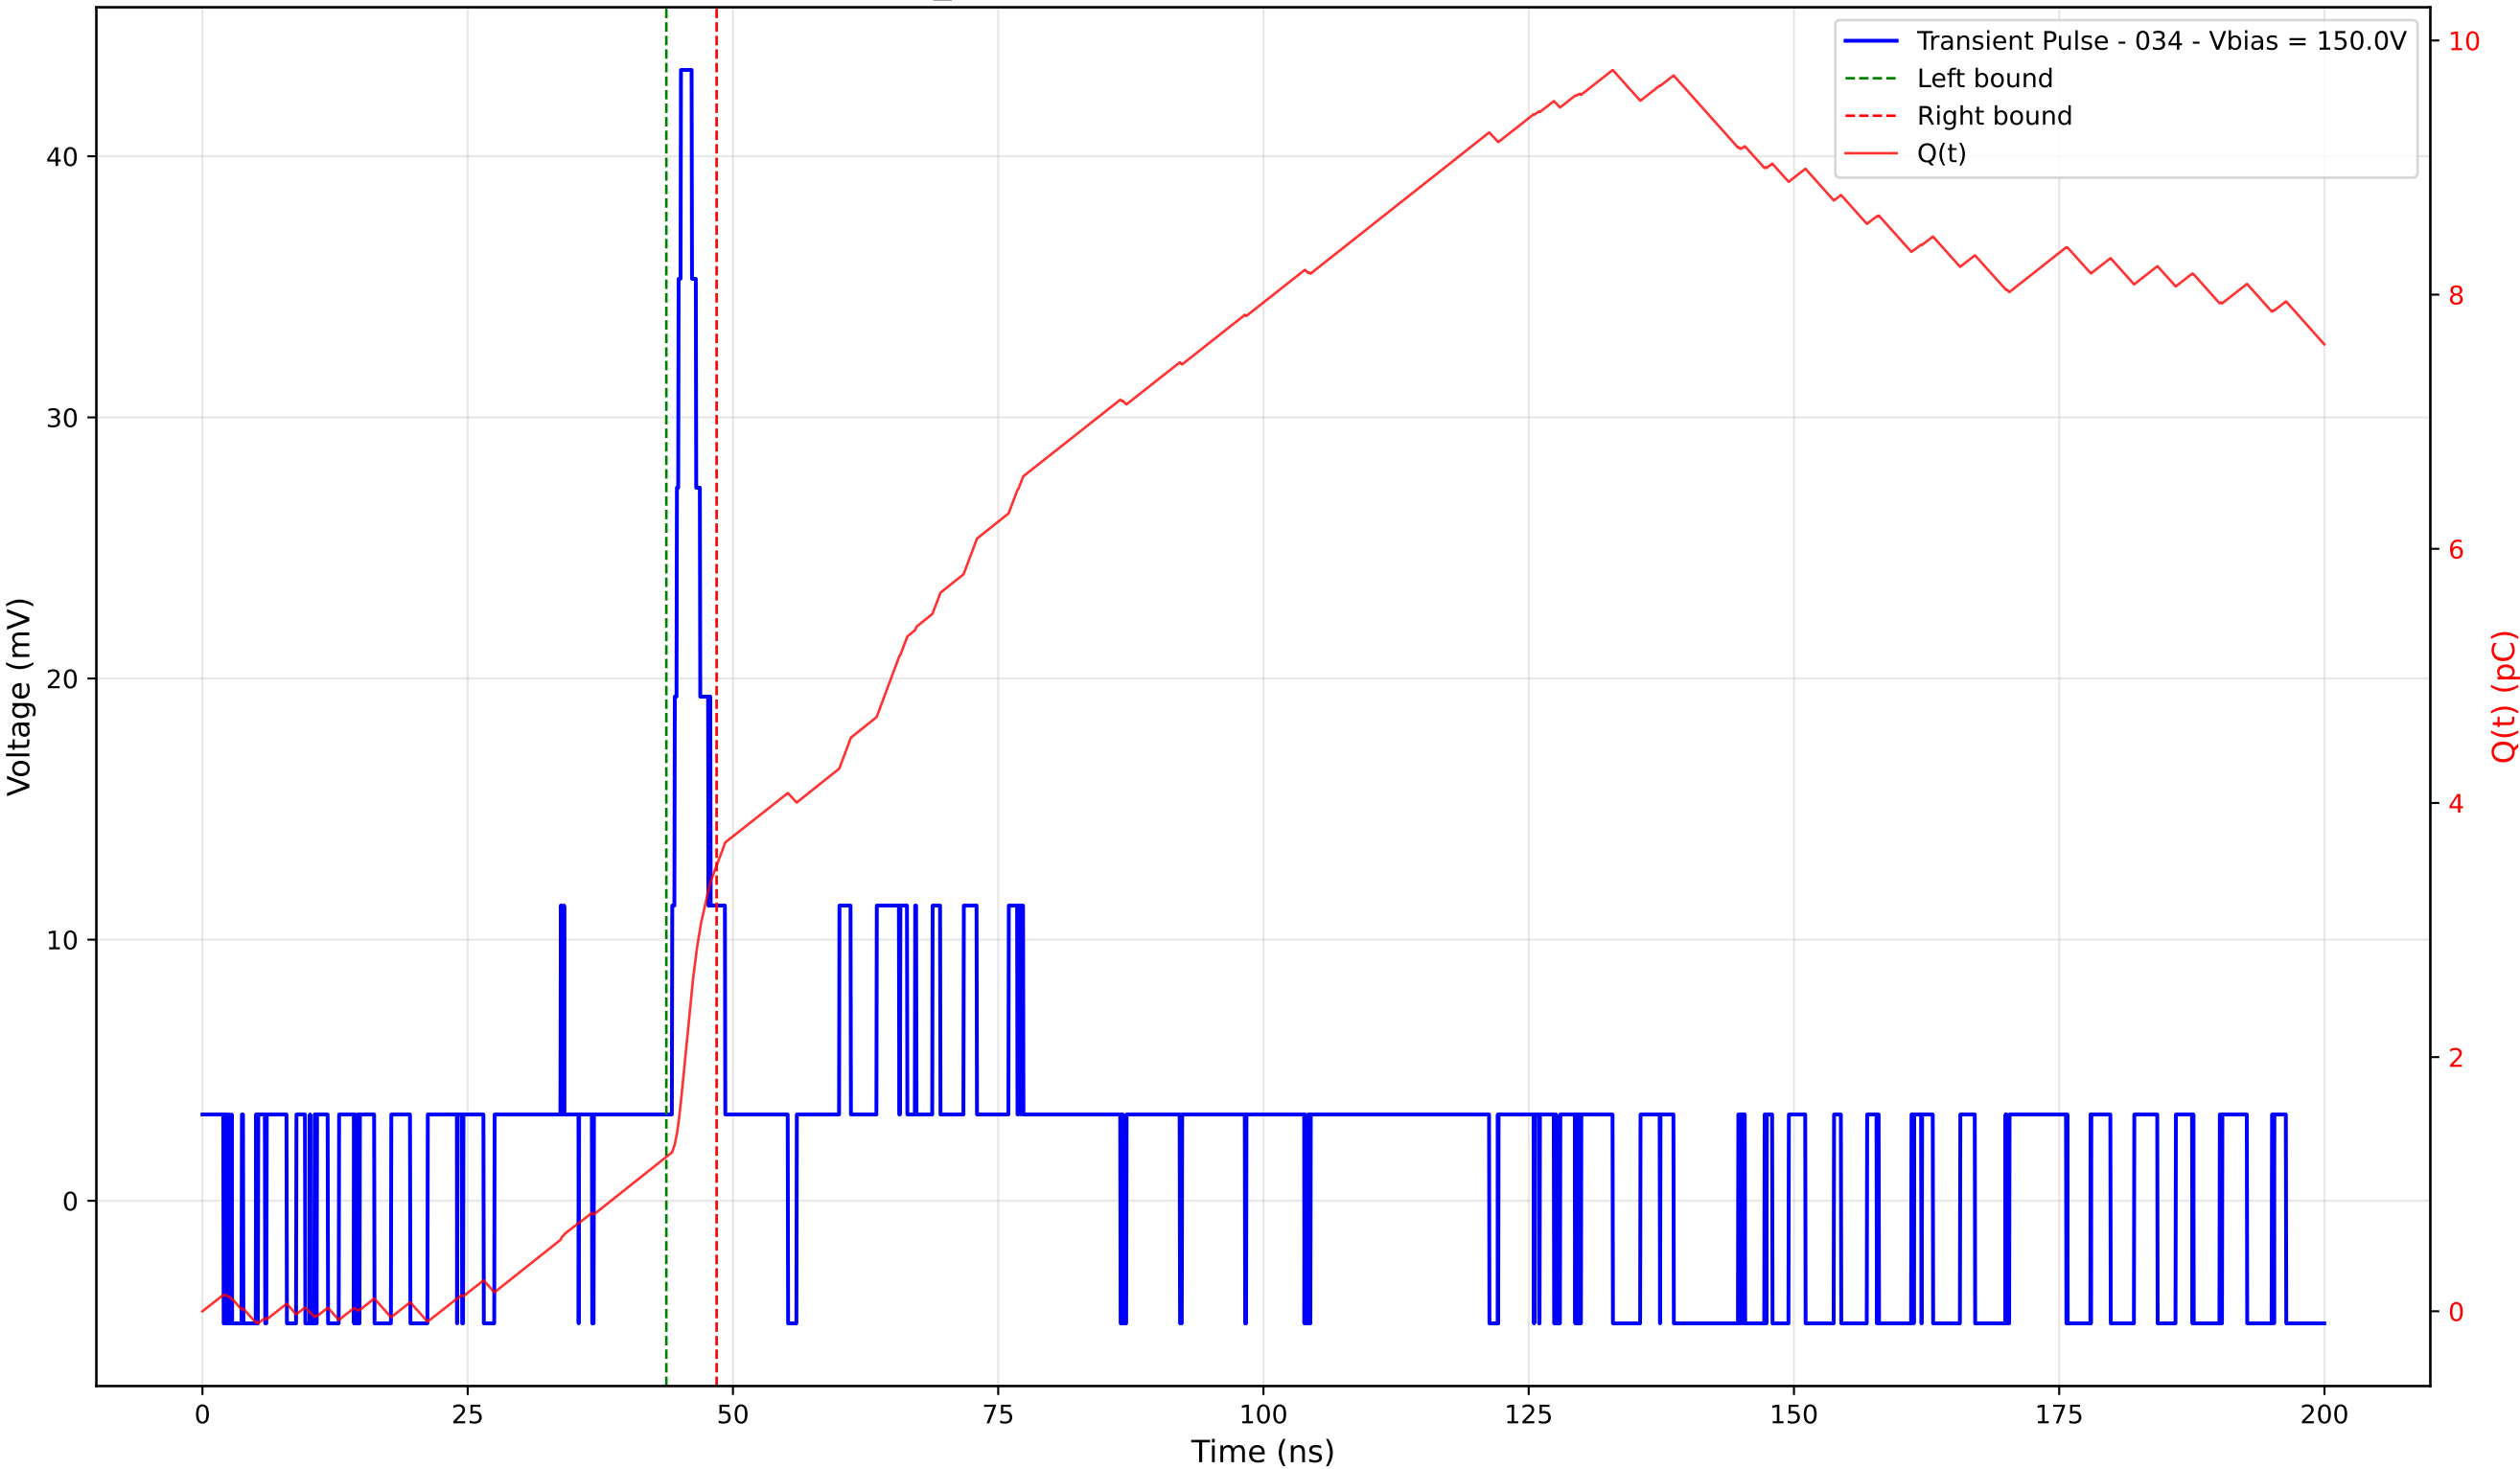

Transient Pulse - Sample: TD_4004 - Position: 435.0 μm - Charge: 2.41 pC - Rise Time: 0.92 ns

