


TCT Run 037 Summary

Parameter	Value
Run	Run037
Surface	N/A
Edge	x
Sample	TD_4004
Vbias (V)	75.0
DAC (%)	56.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\Run037
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

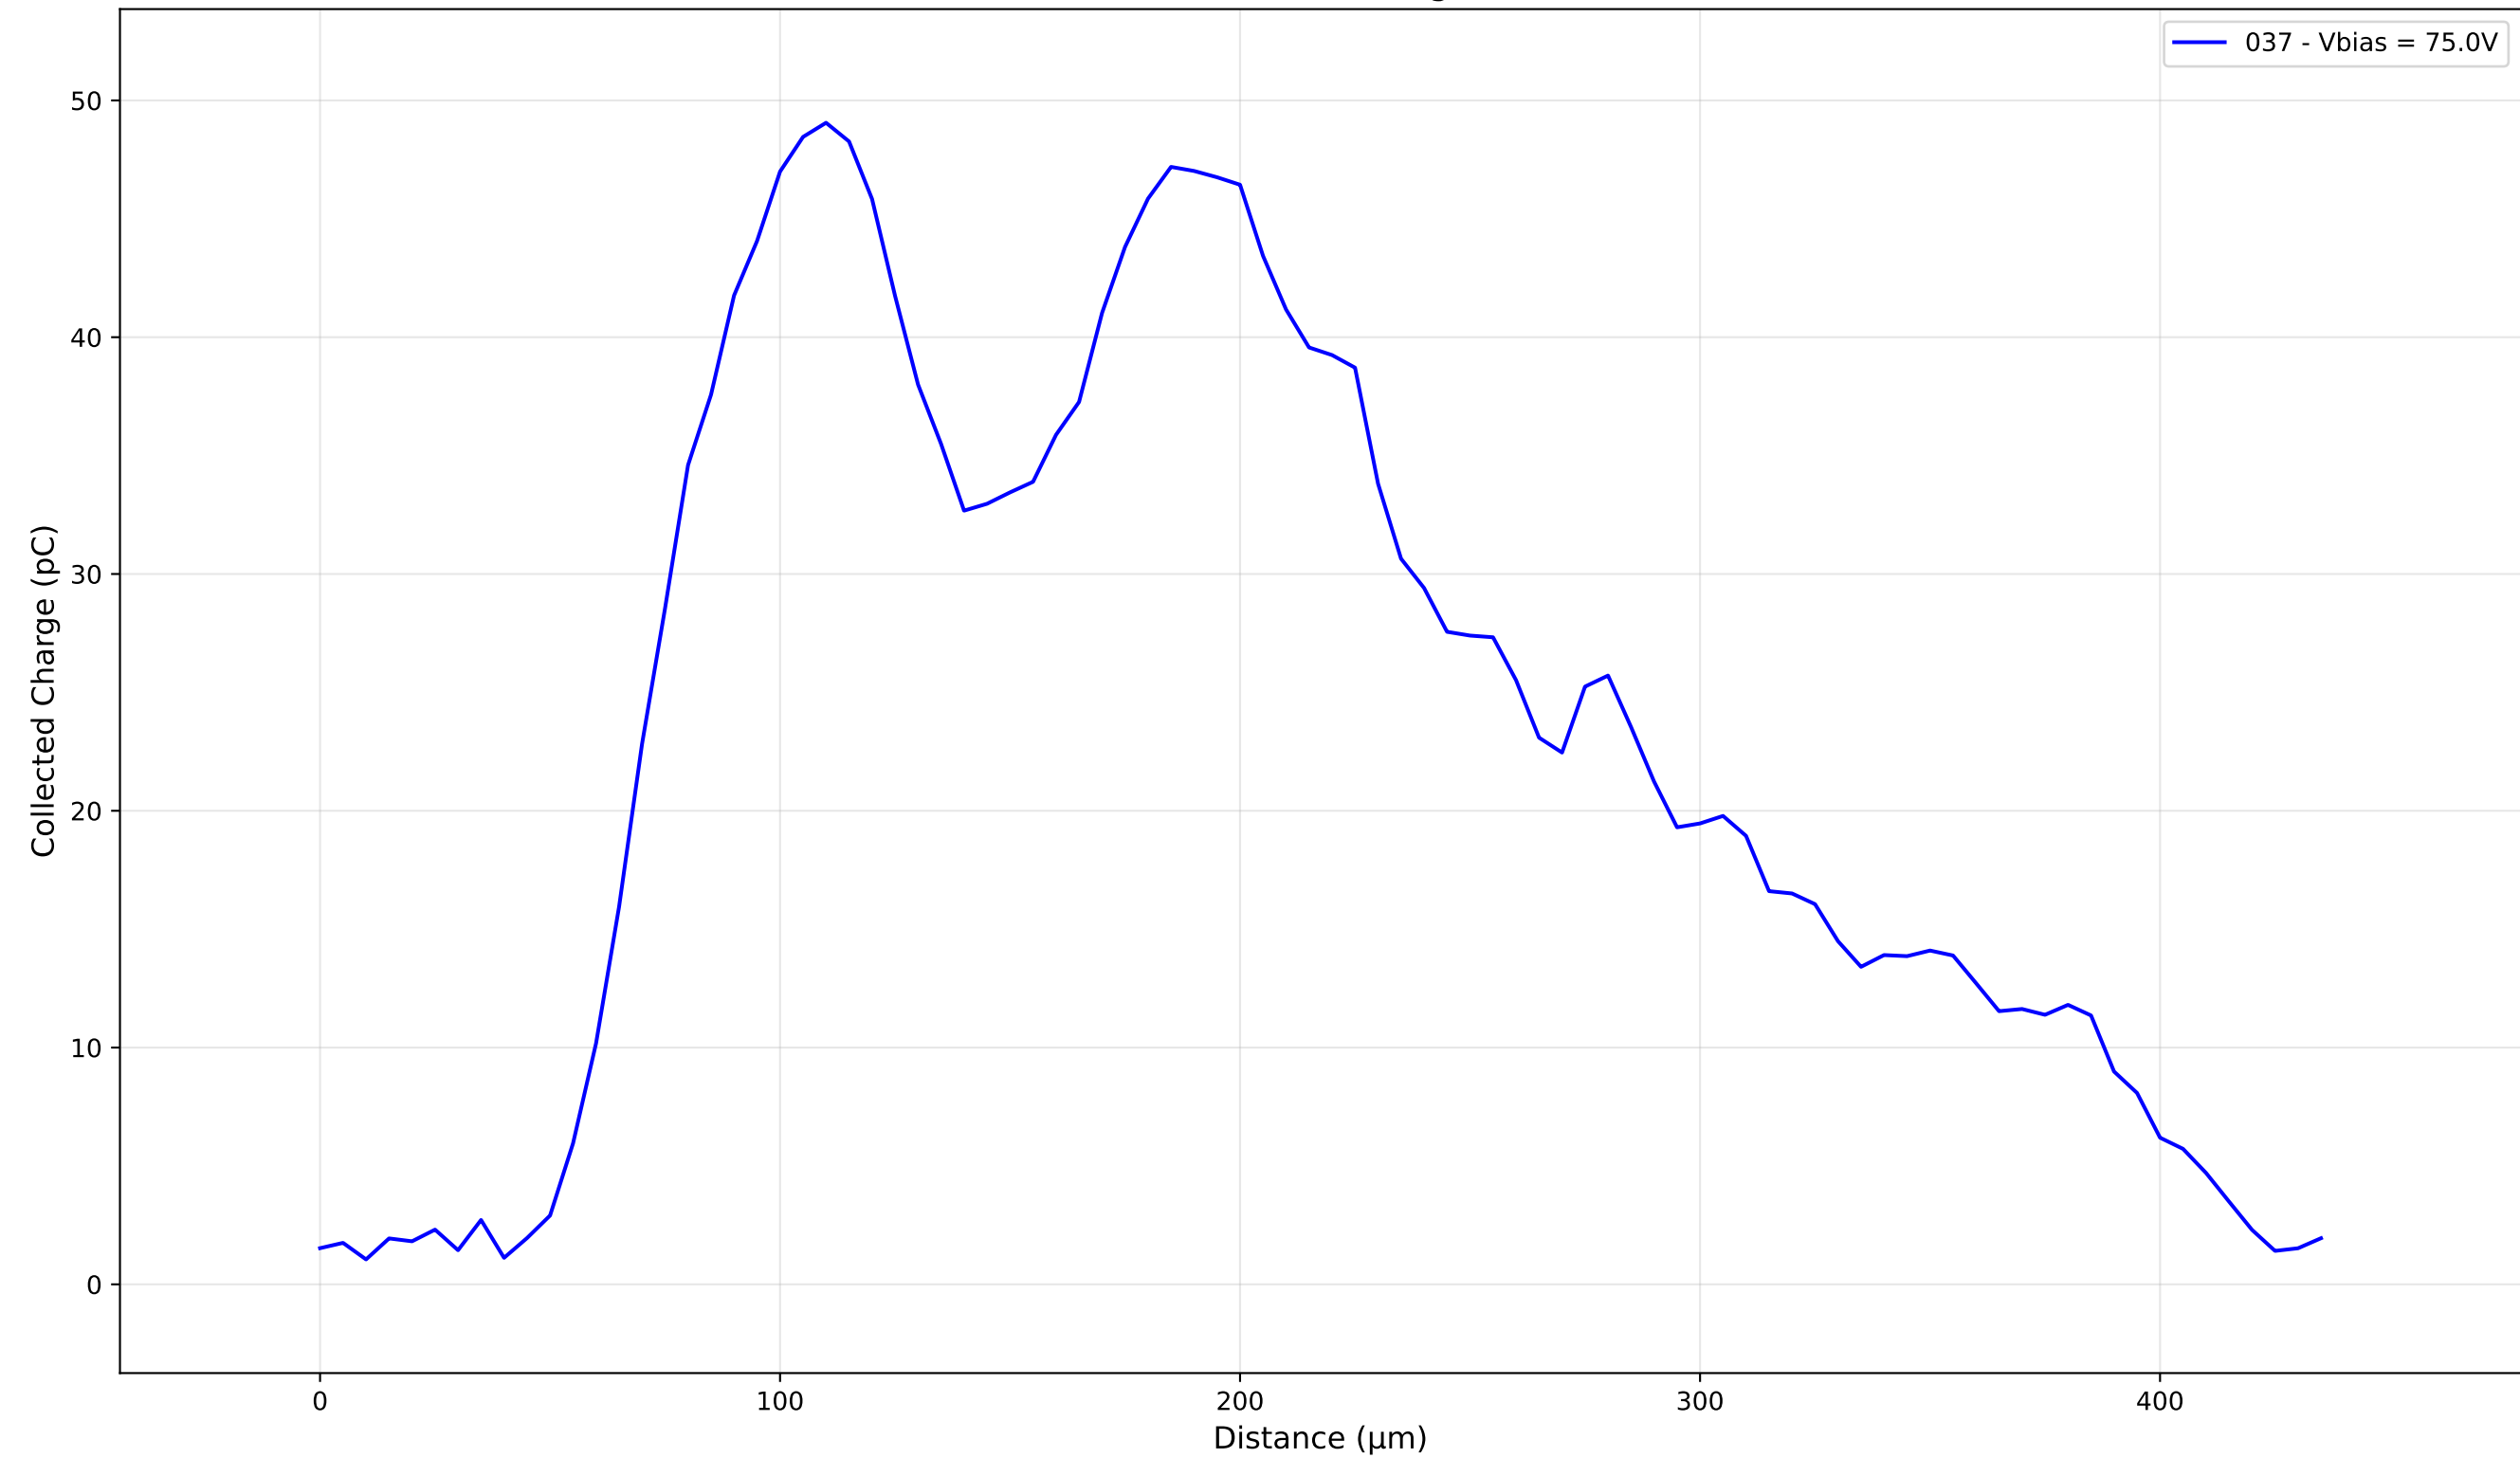

Collected Charge

037 - Vbias = 75.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

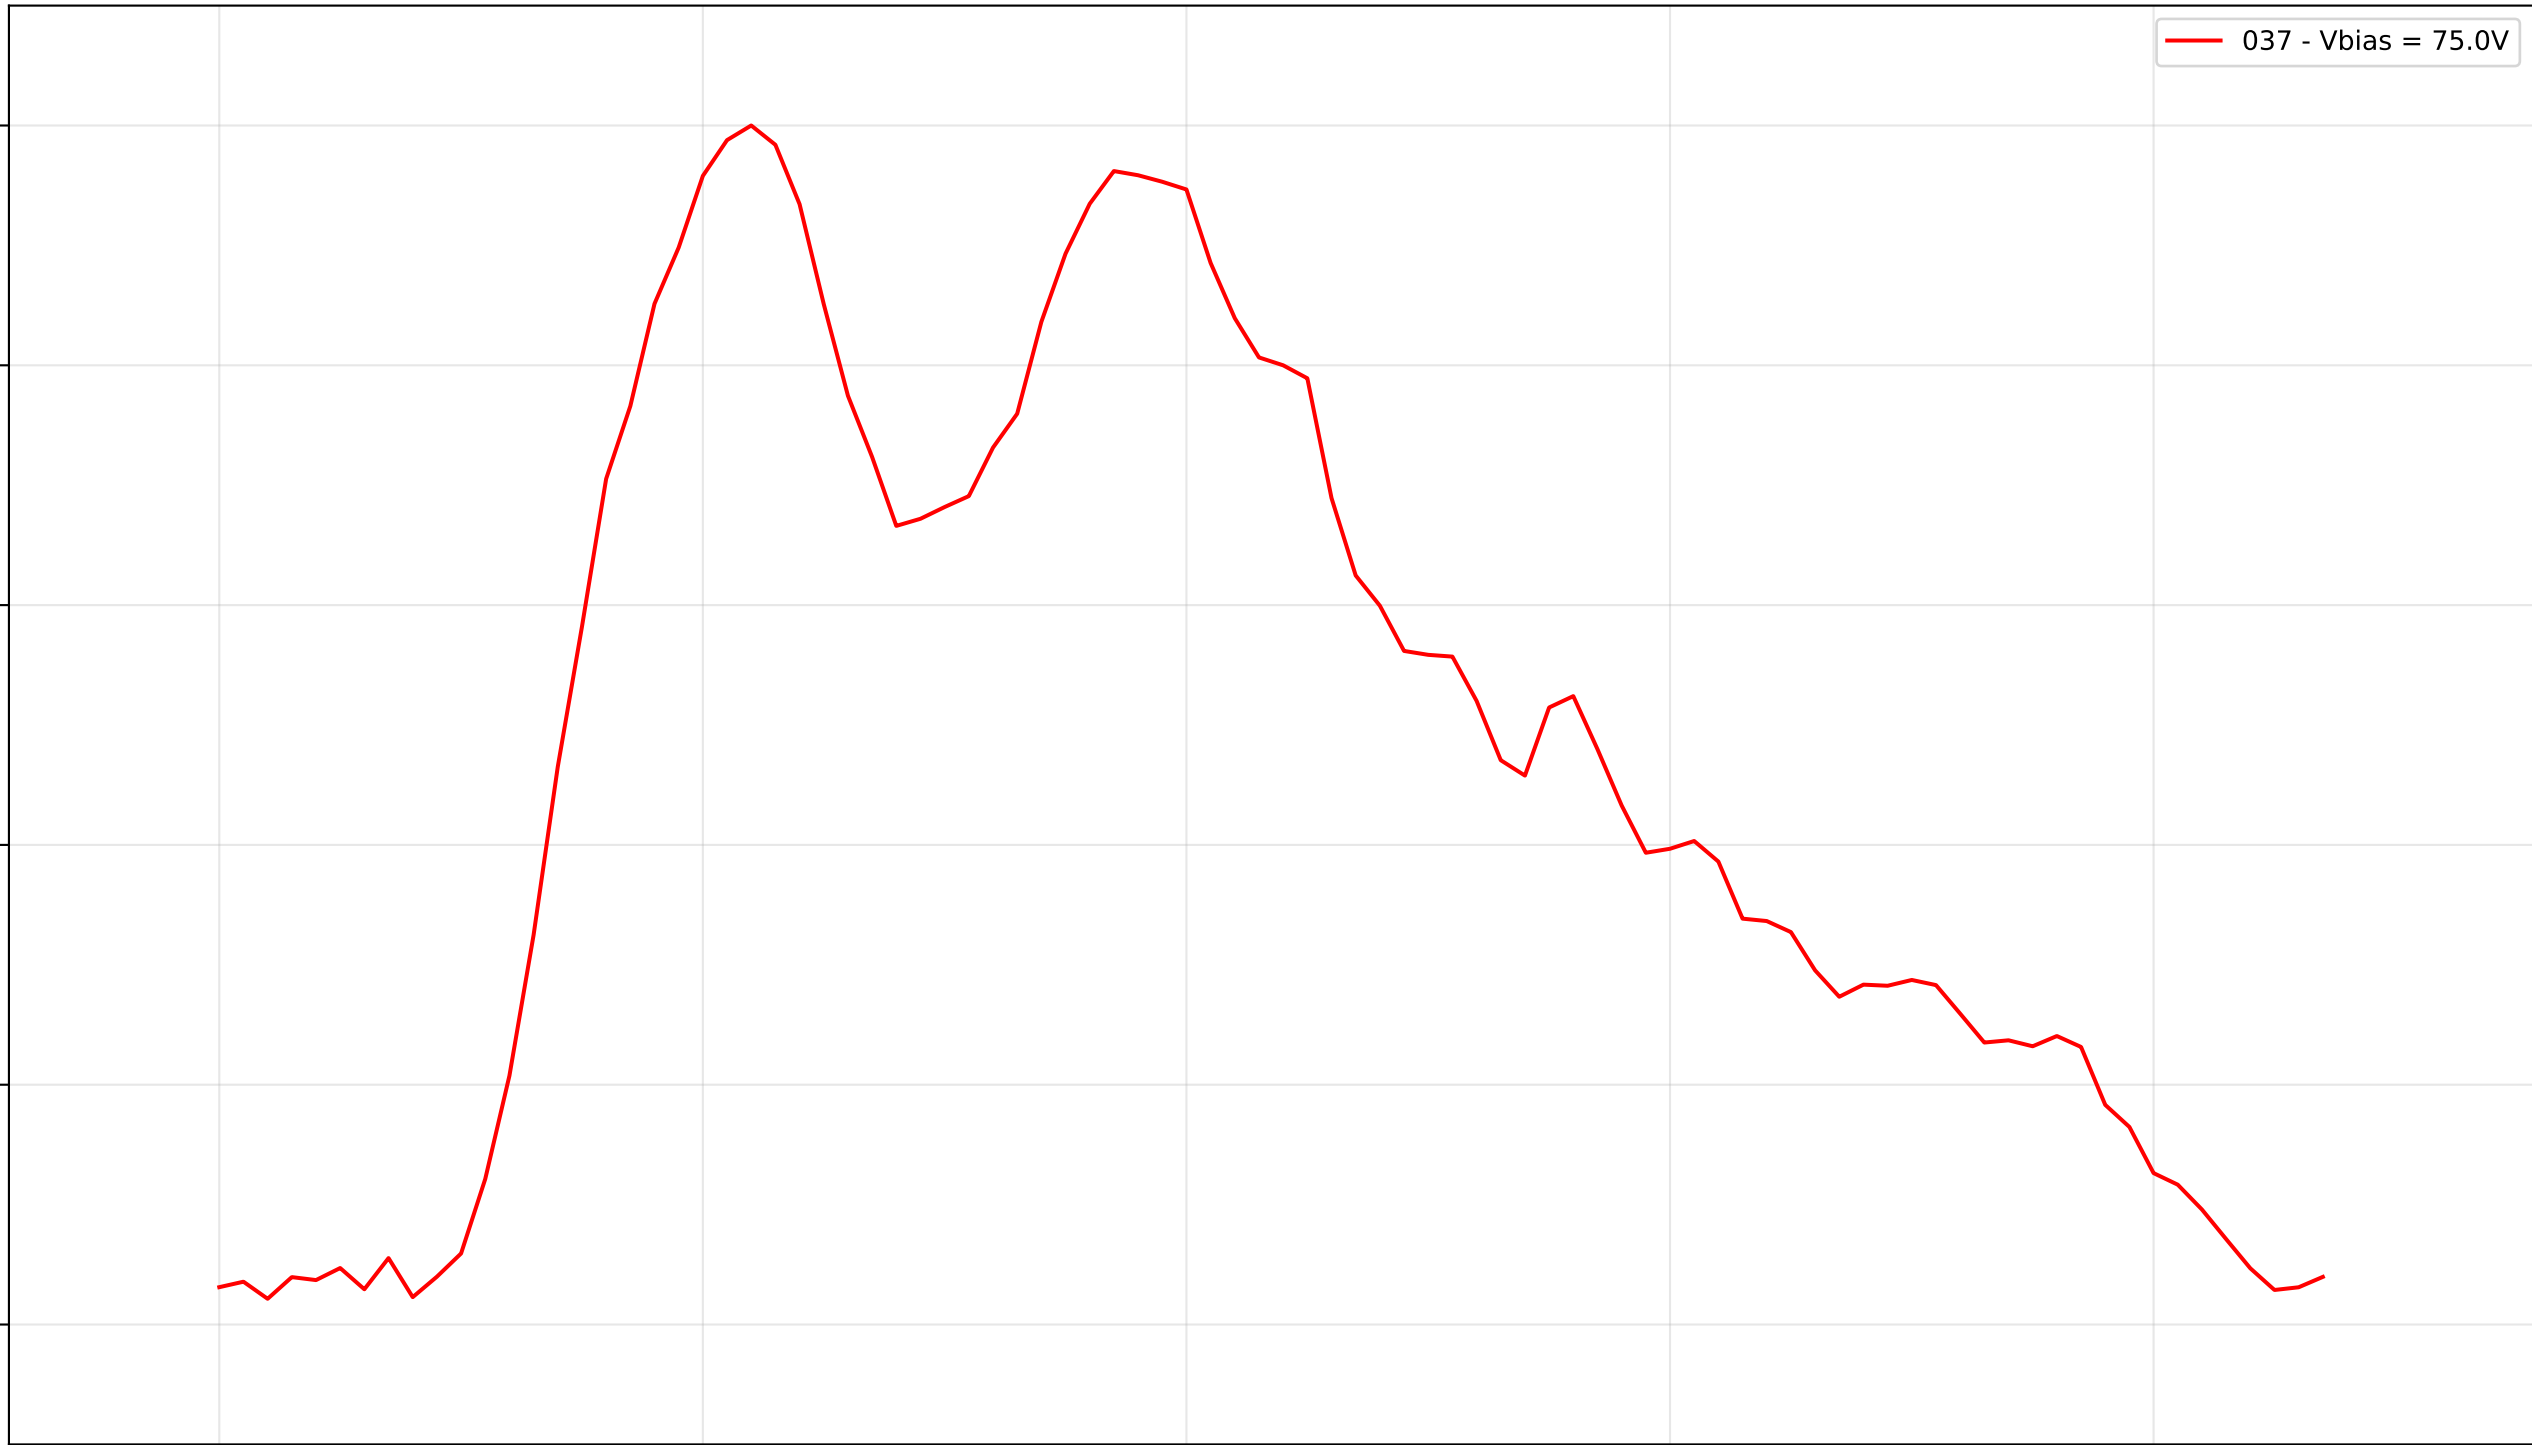


Rise Time

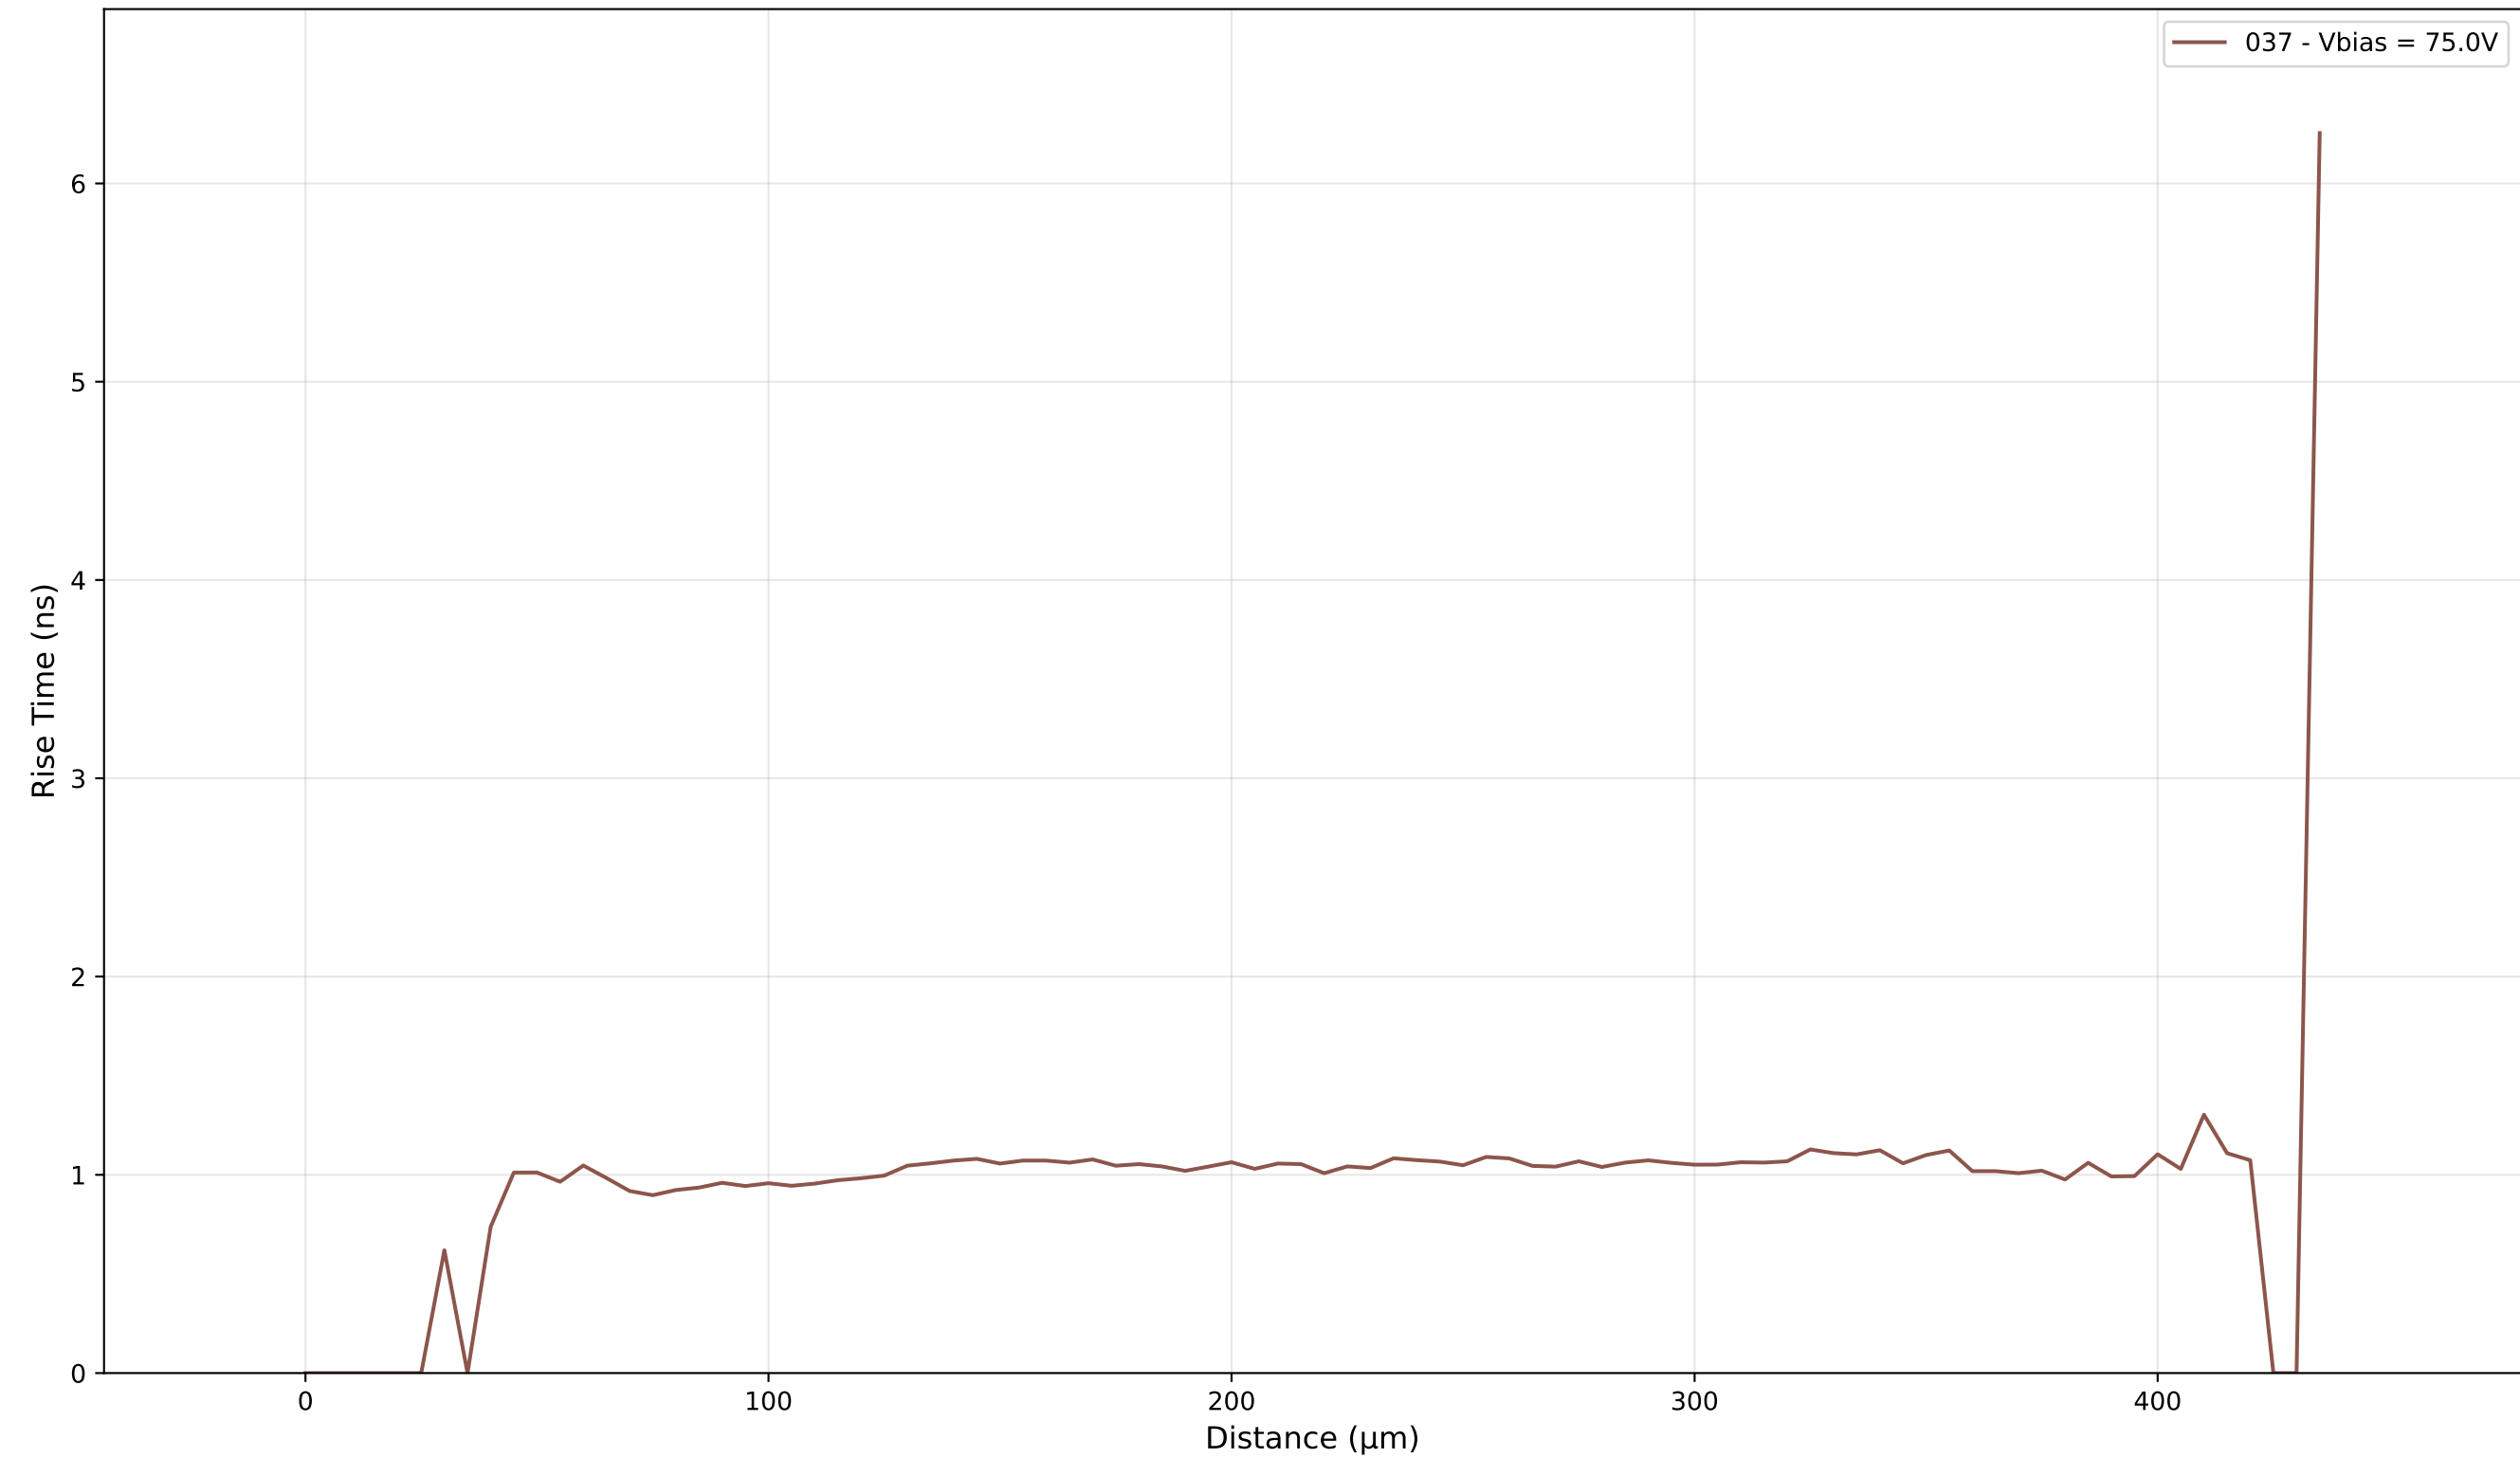


Amplitude

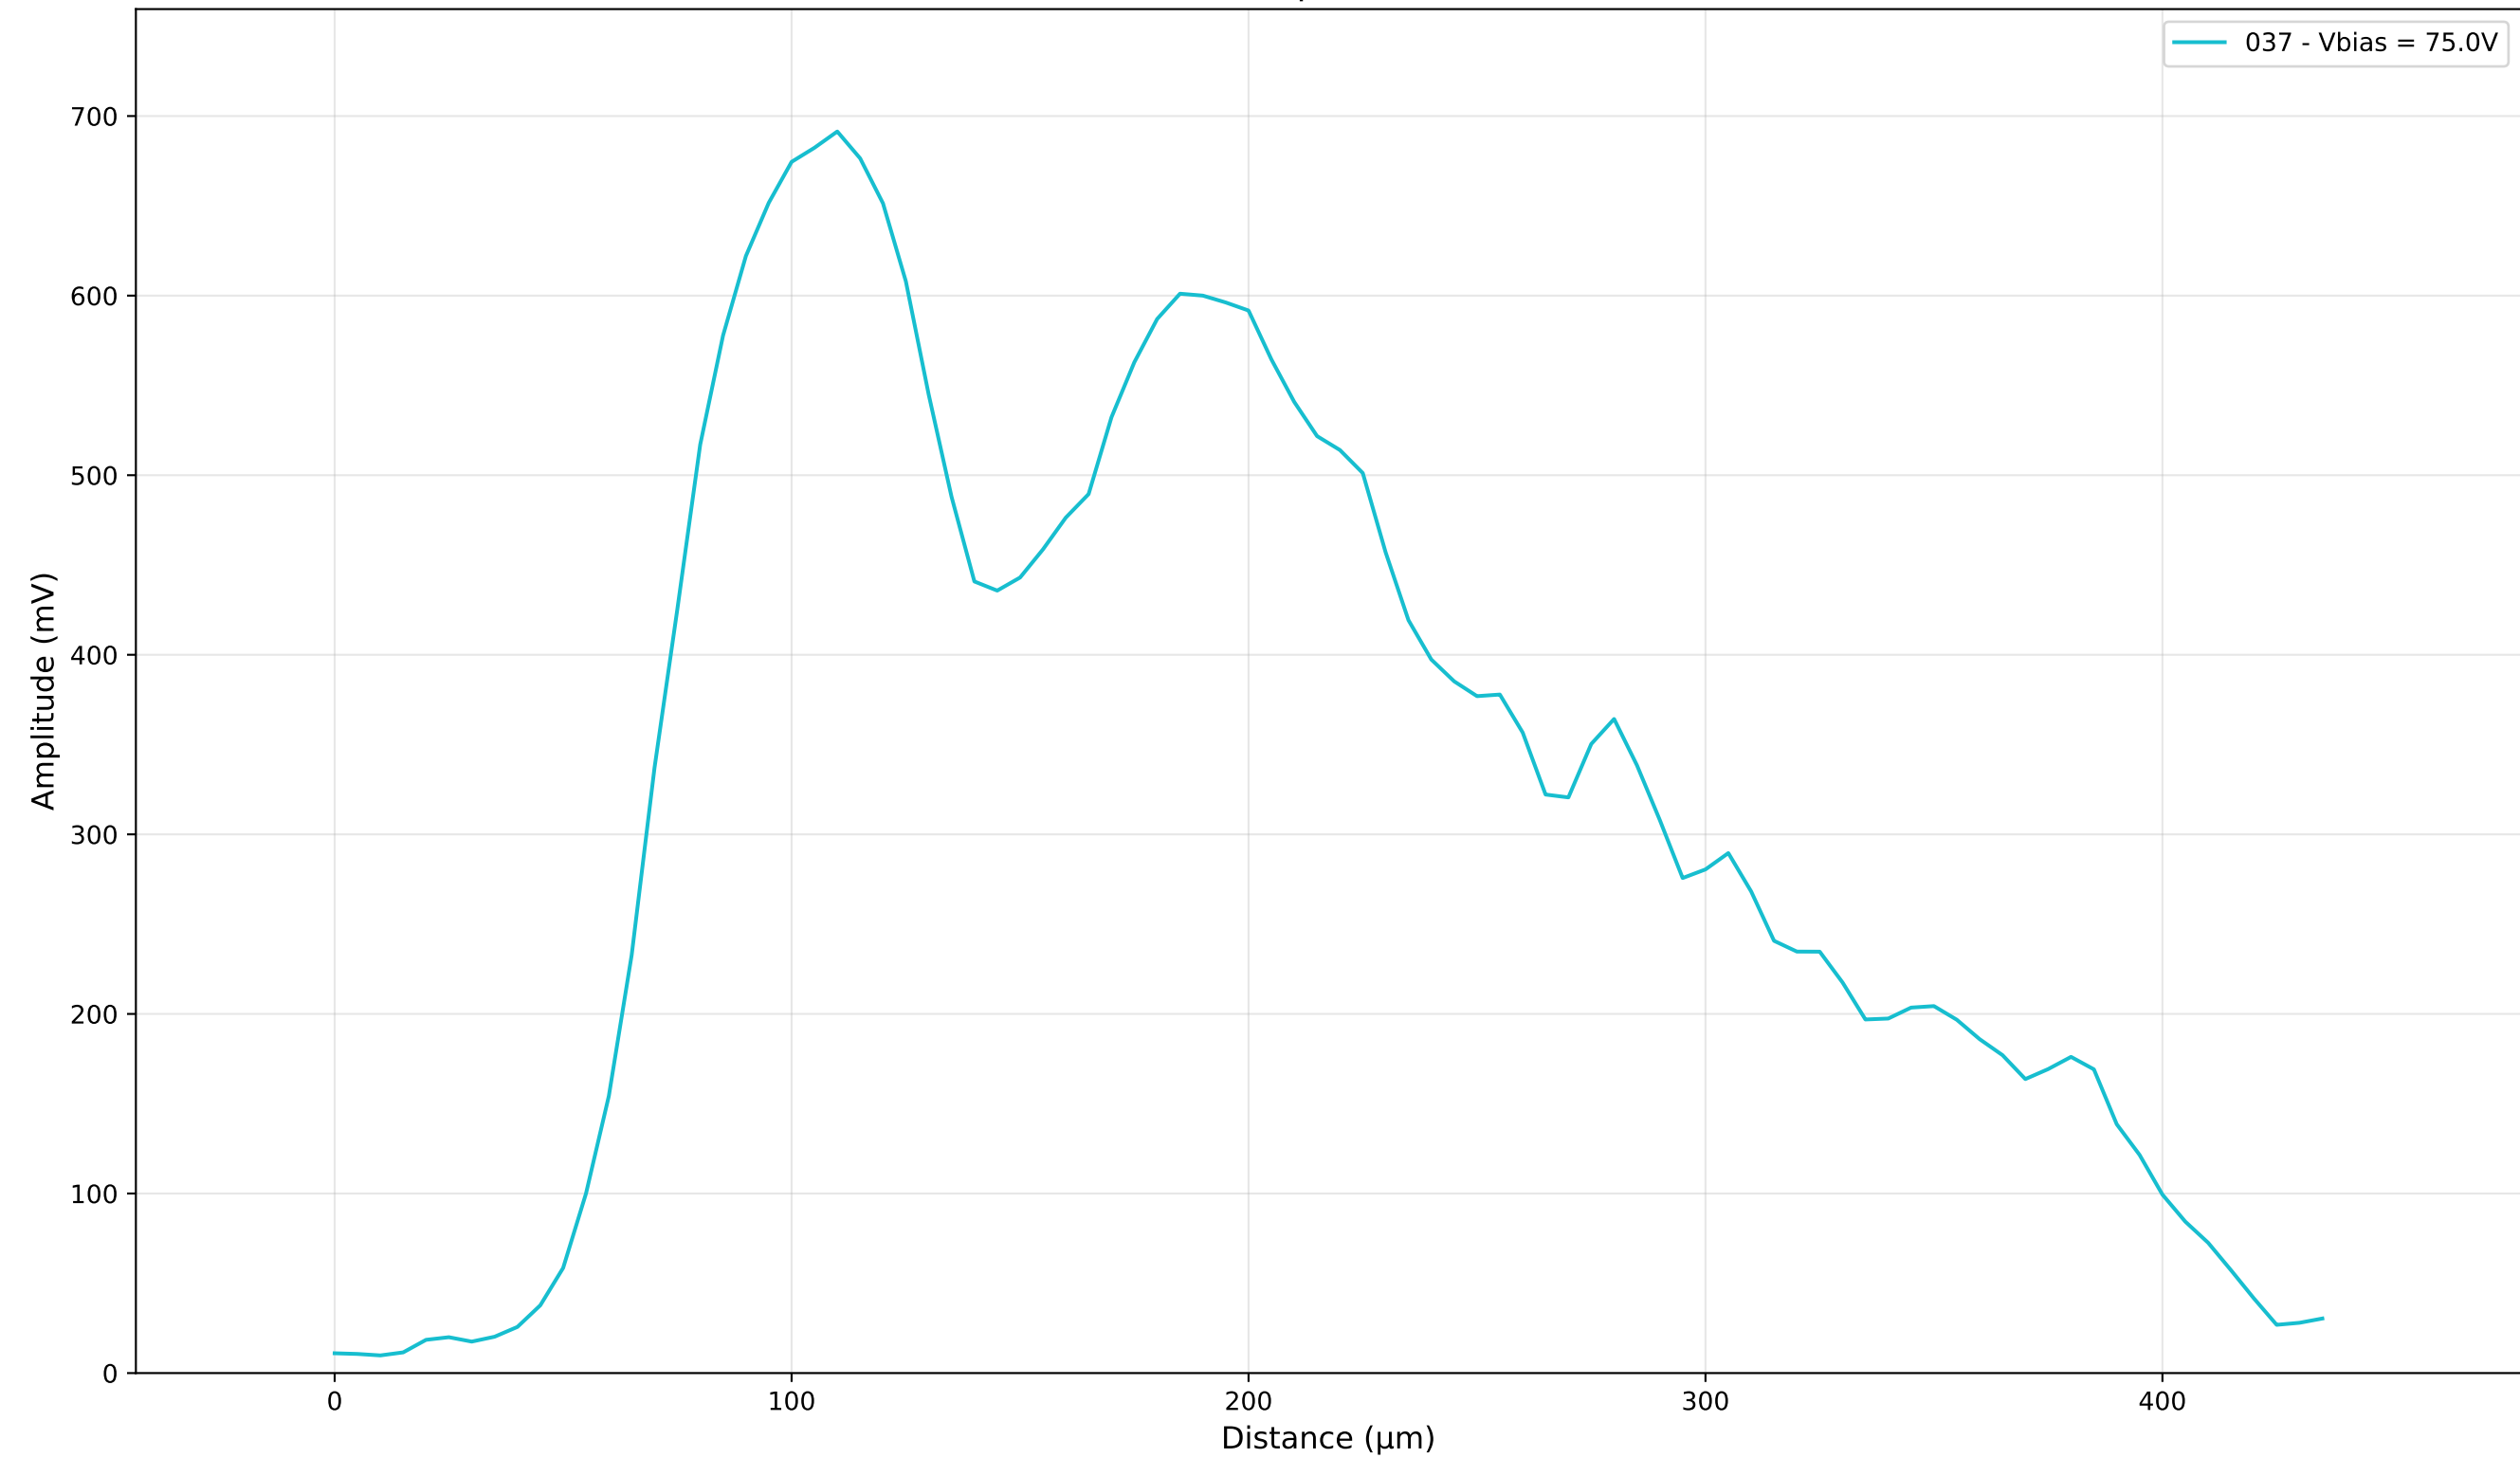


FWHM

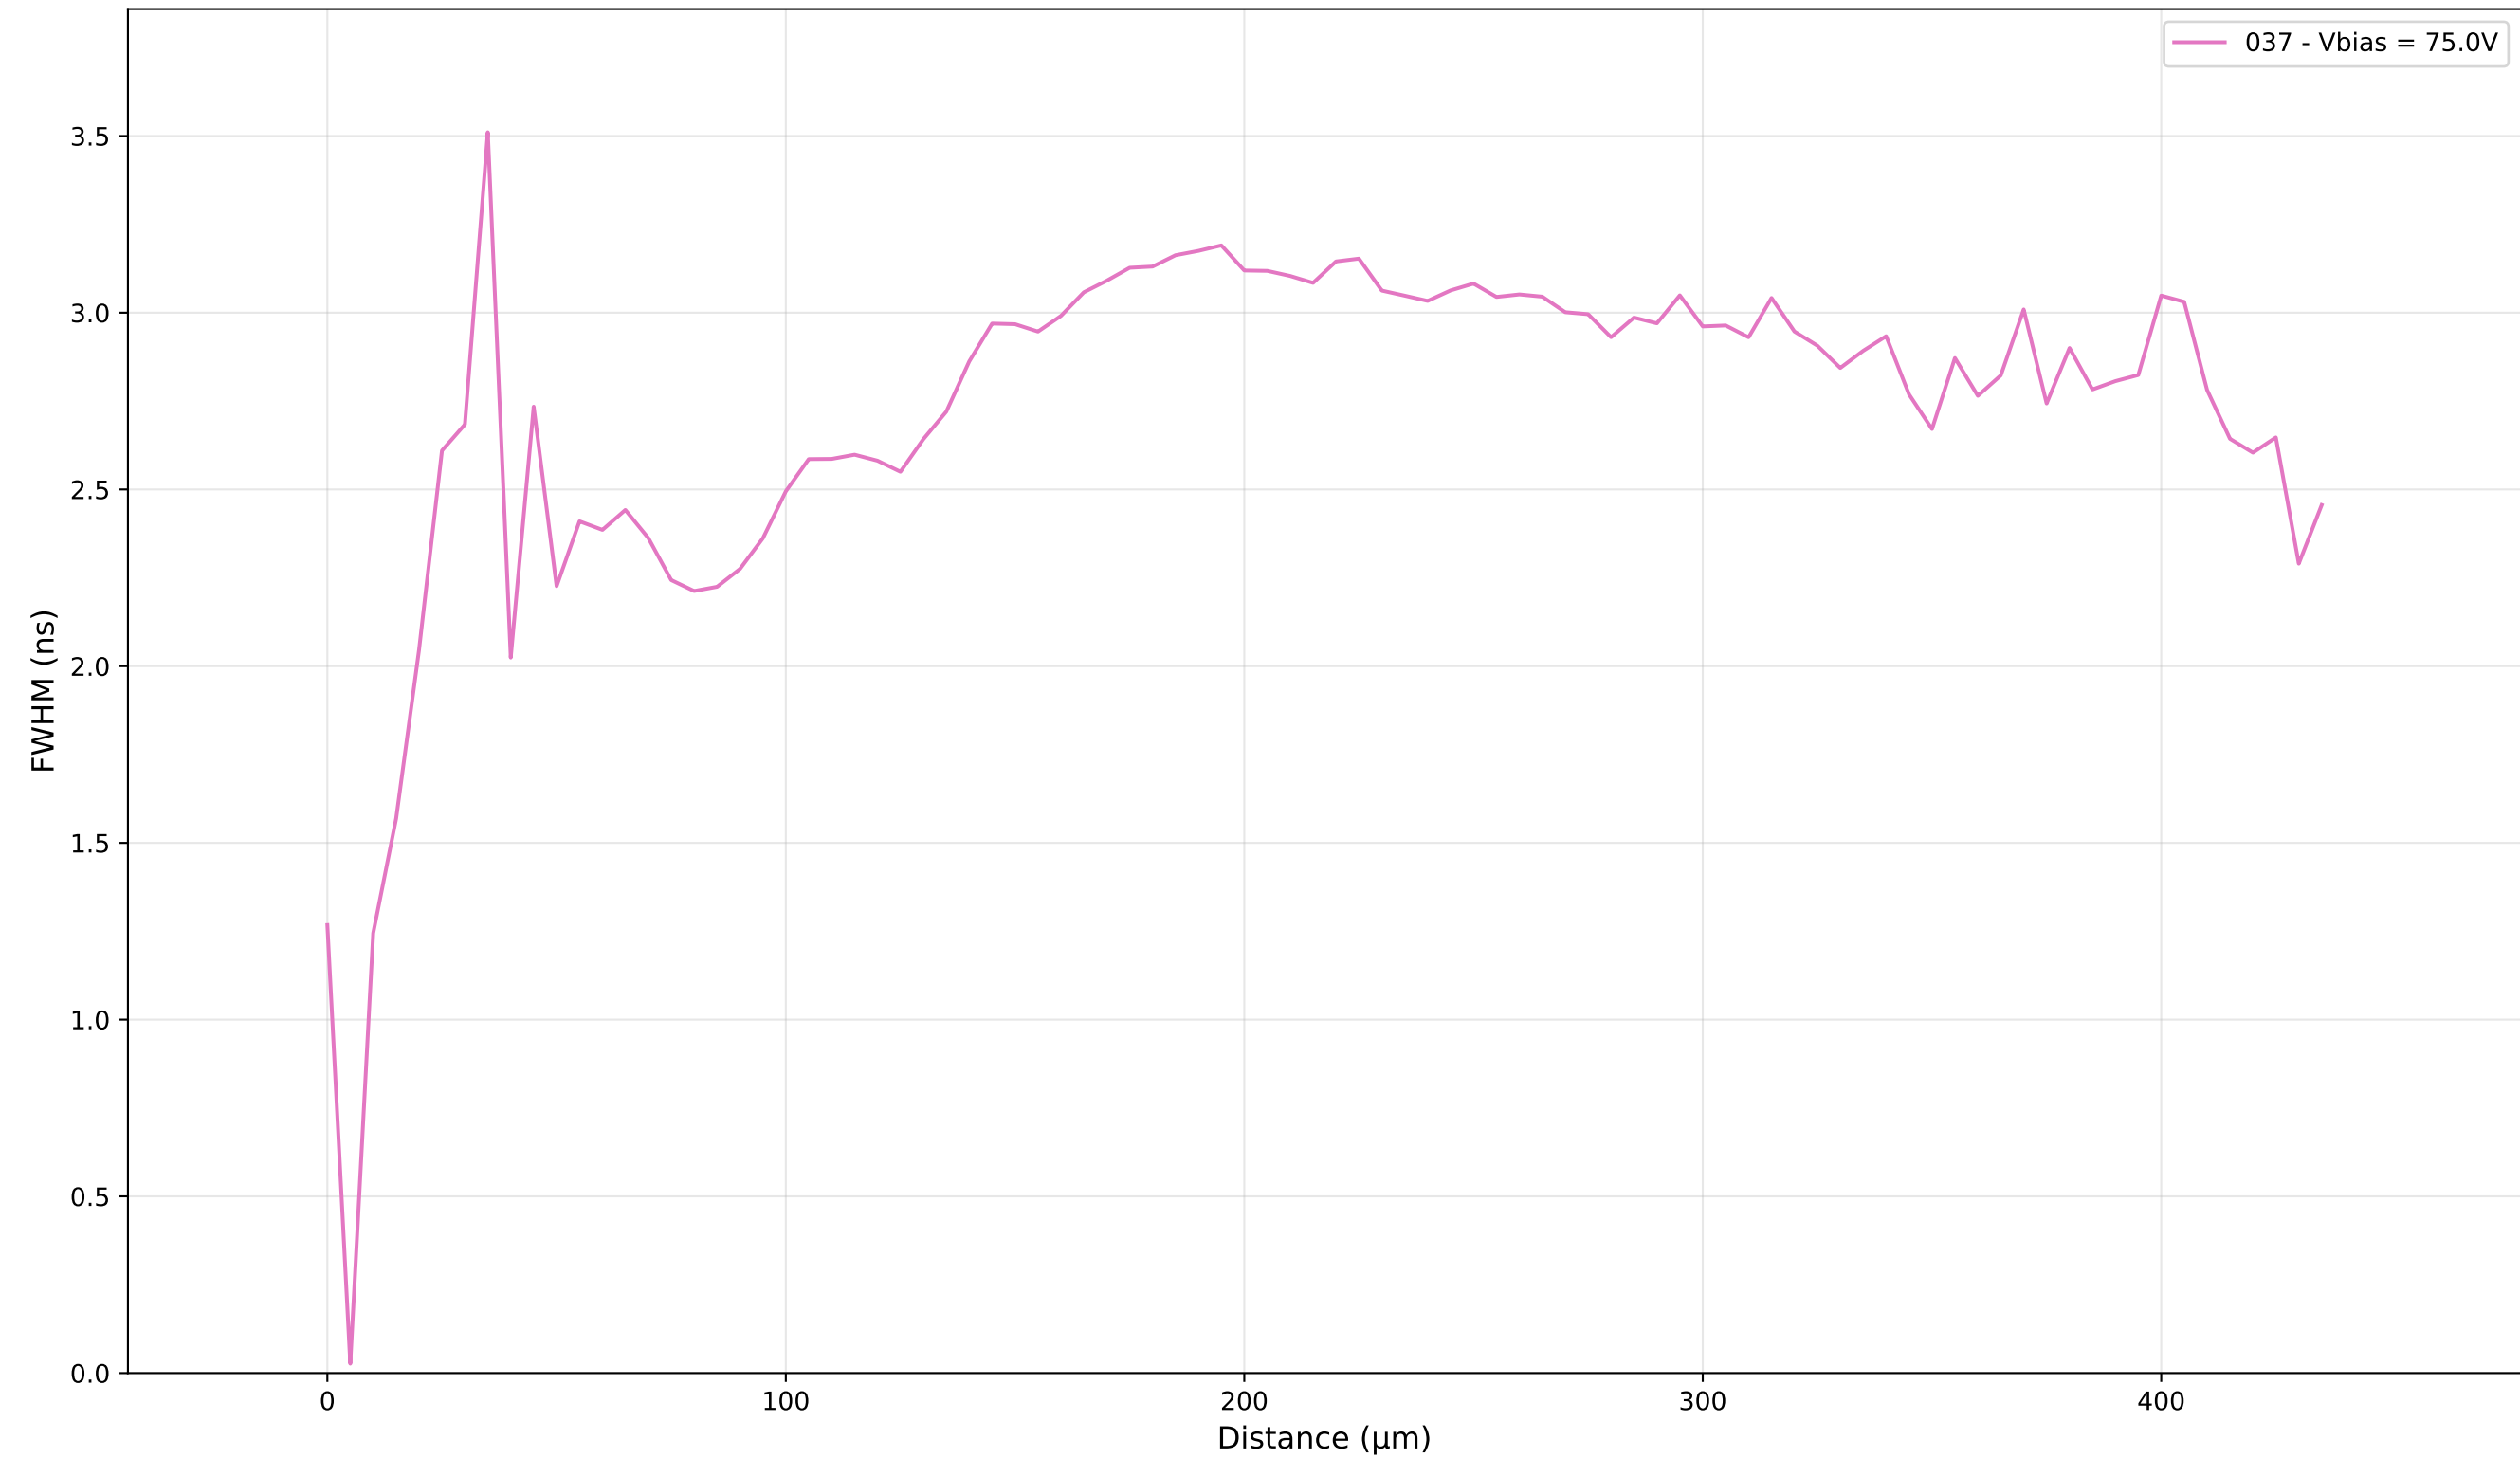


Transient Pulse - Sample: TD_4004 - Position: 0.0 μ m - Charge: 1.53 pC - Rise Time: 0.00 ns (N/A)

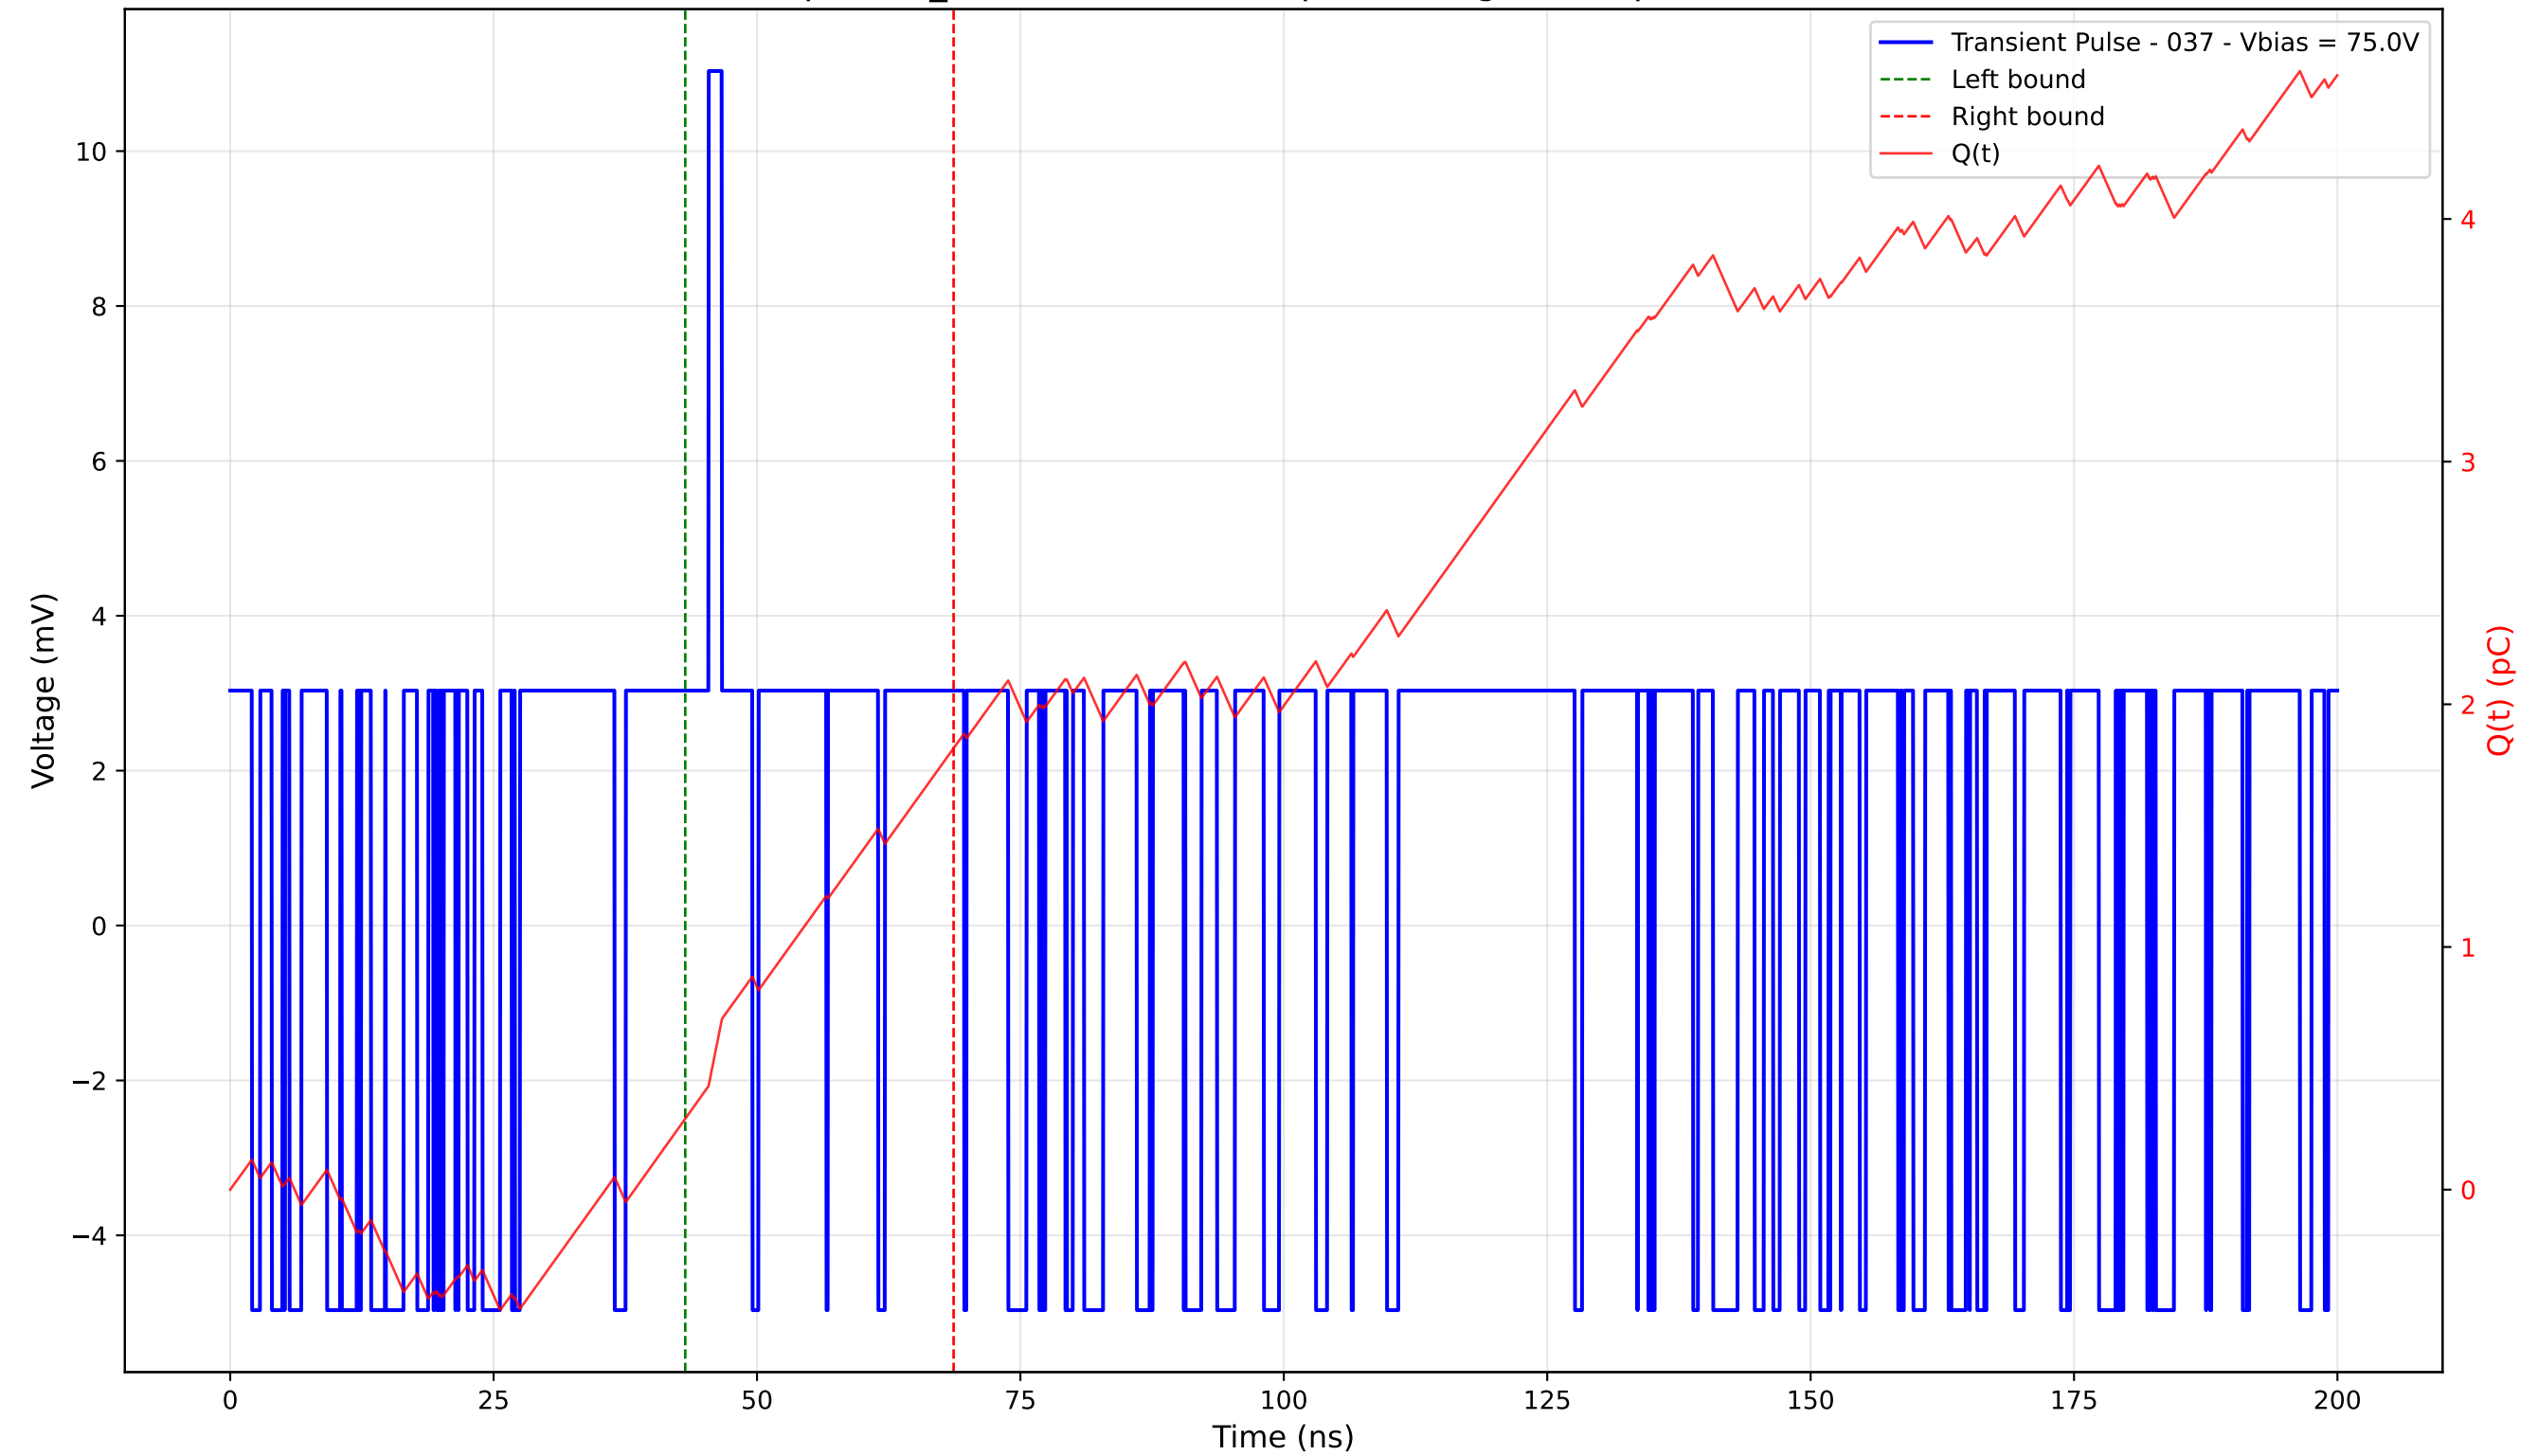


Transient Pulse - Sample: TD_4004 - Position: 5.0 μ m - Charge: 1.75 pC - Rise Time: 0.00 ns (N/A)

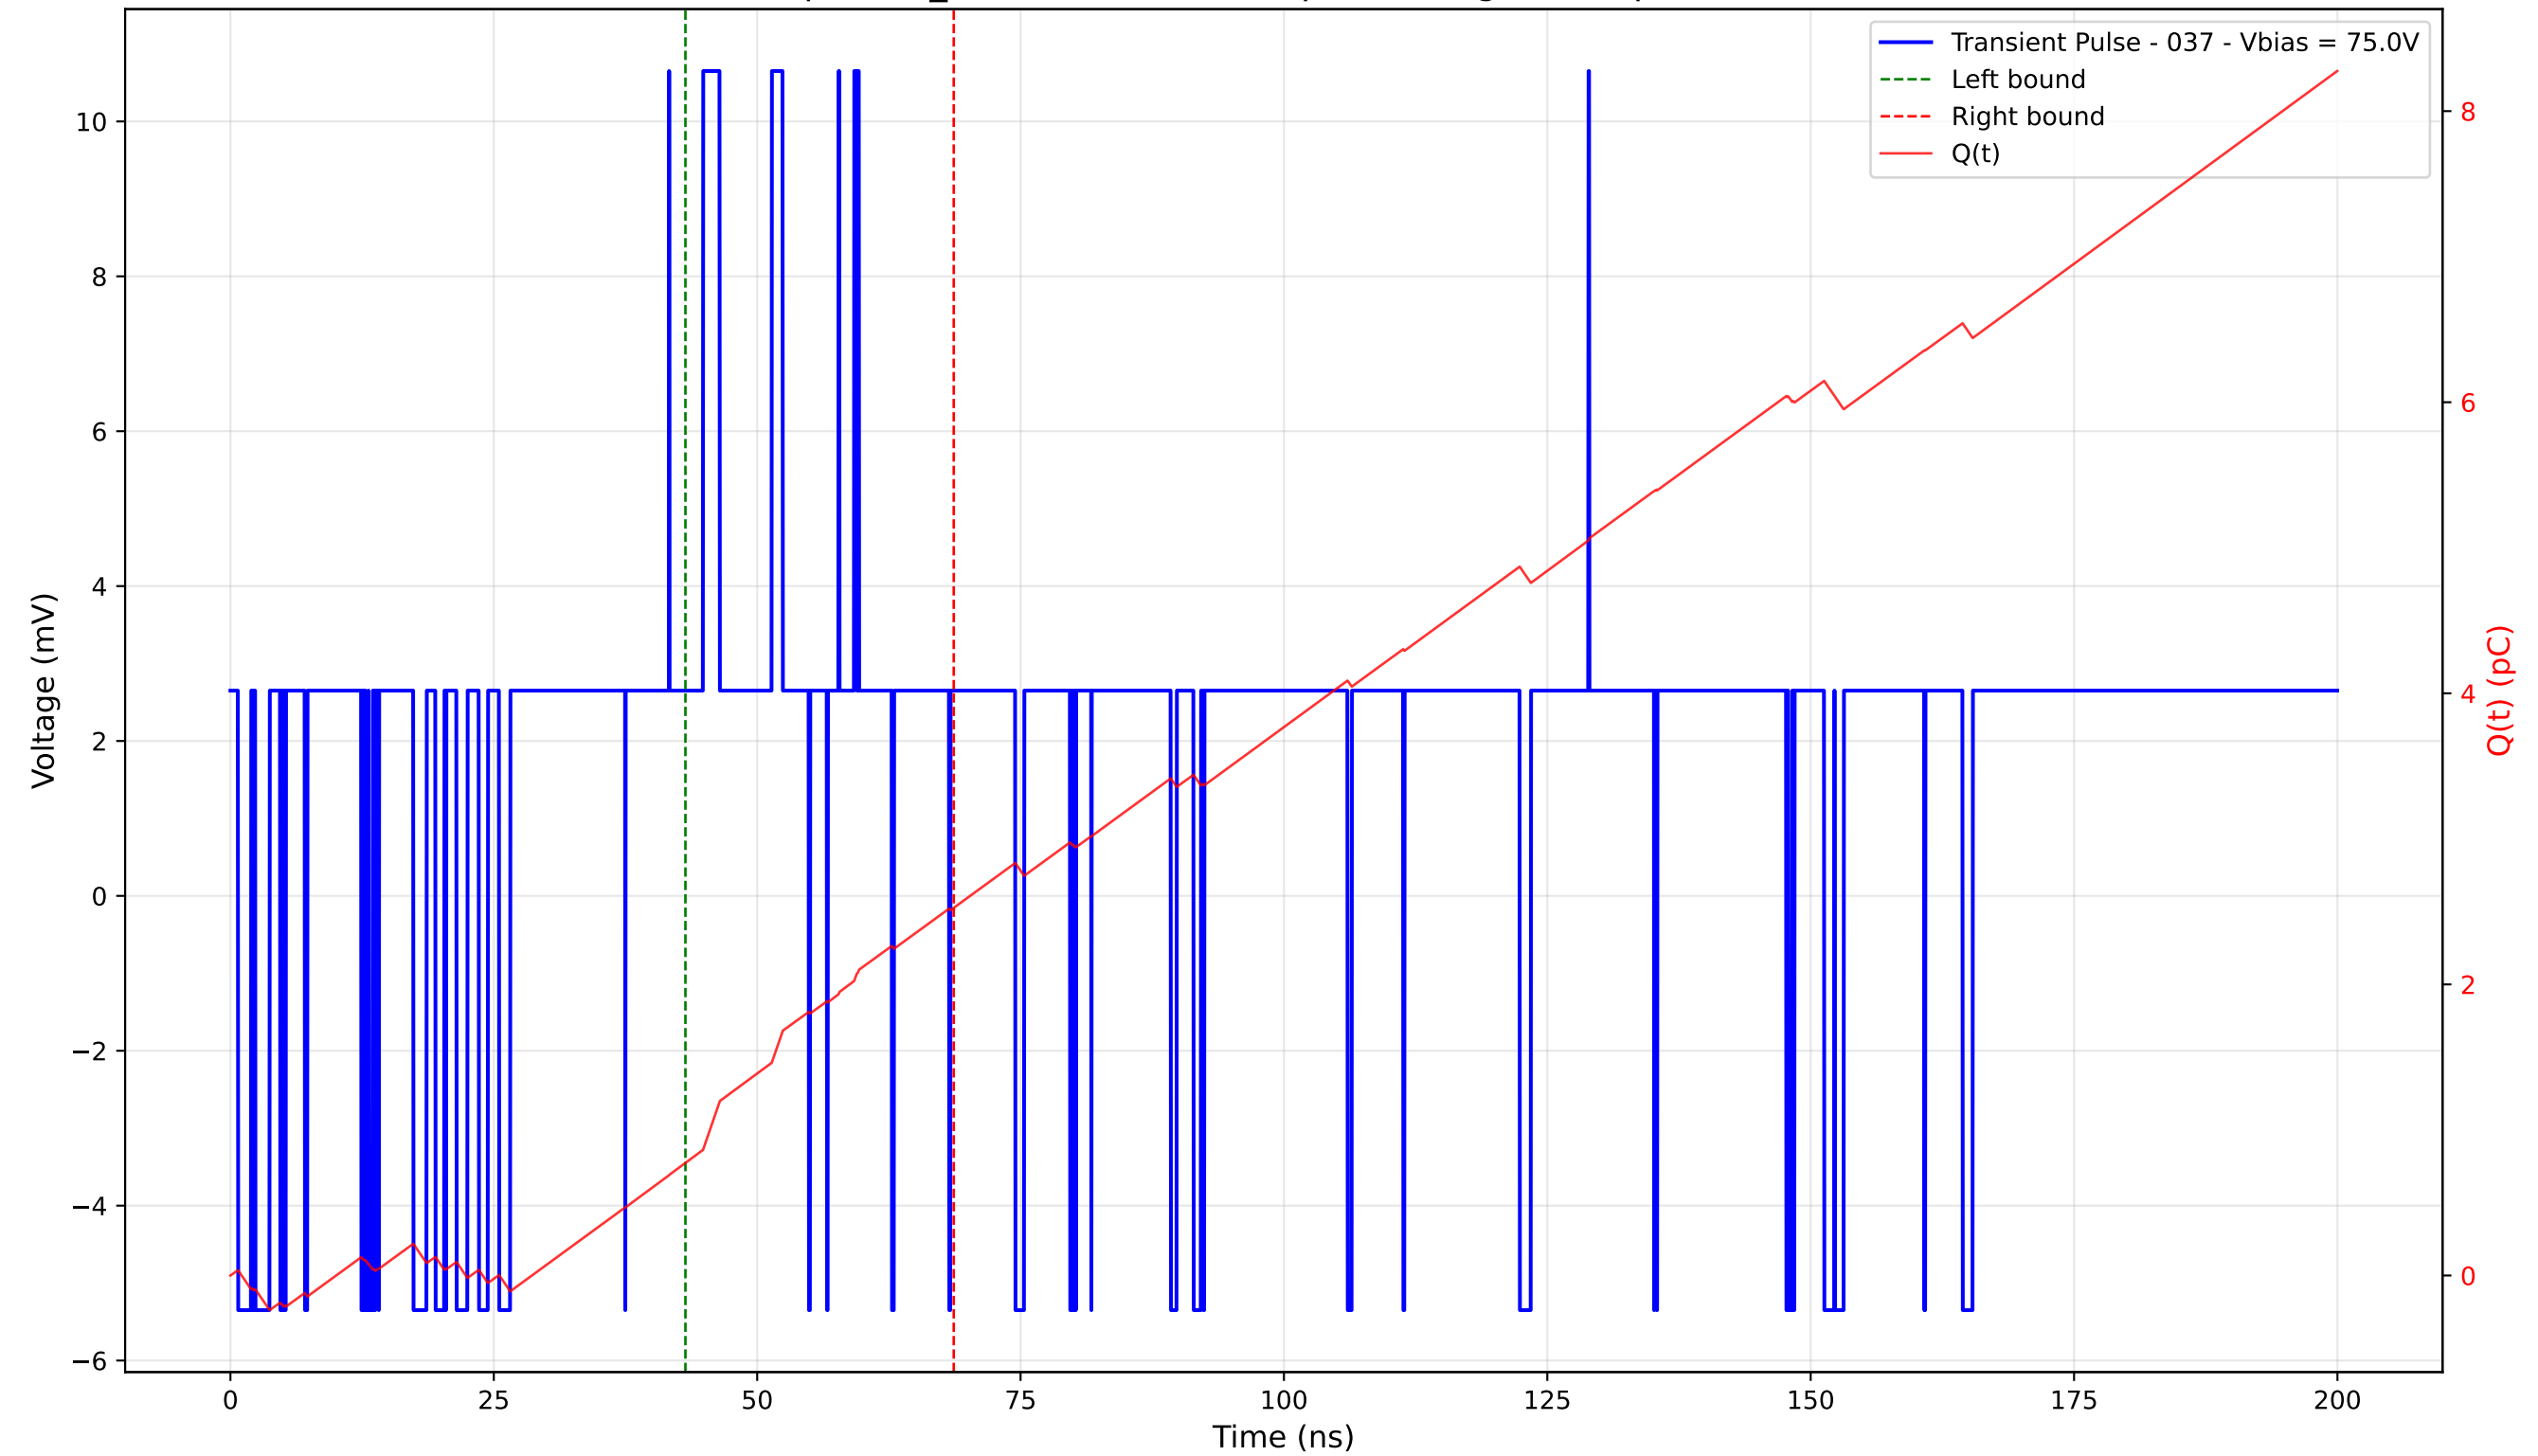


Transient Pulse - Sample: TD_4004 - Position: 10.0 μm - Charge: 1.05 pC - Rise Time: 0.00 ns (N/A)

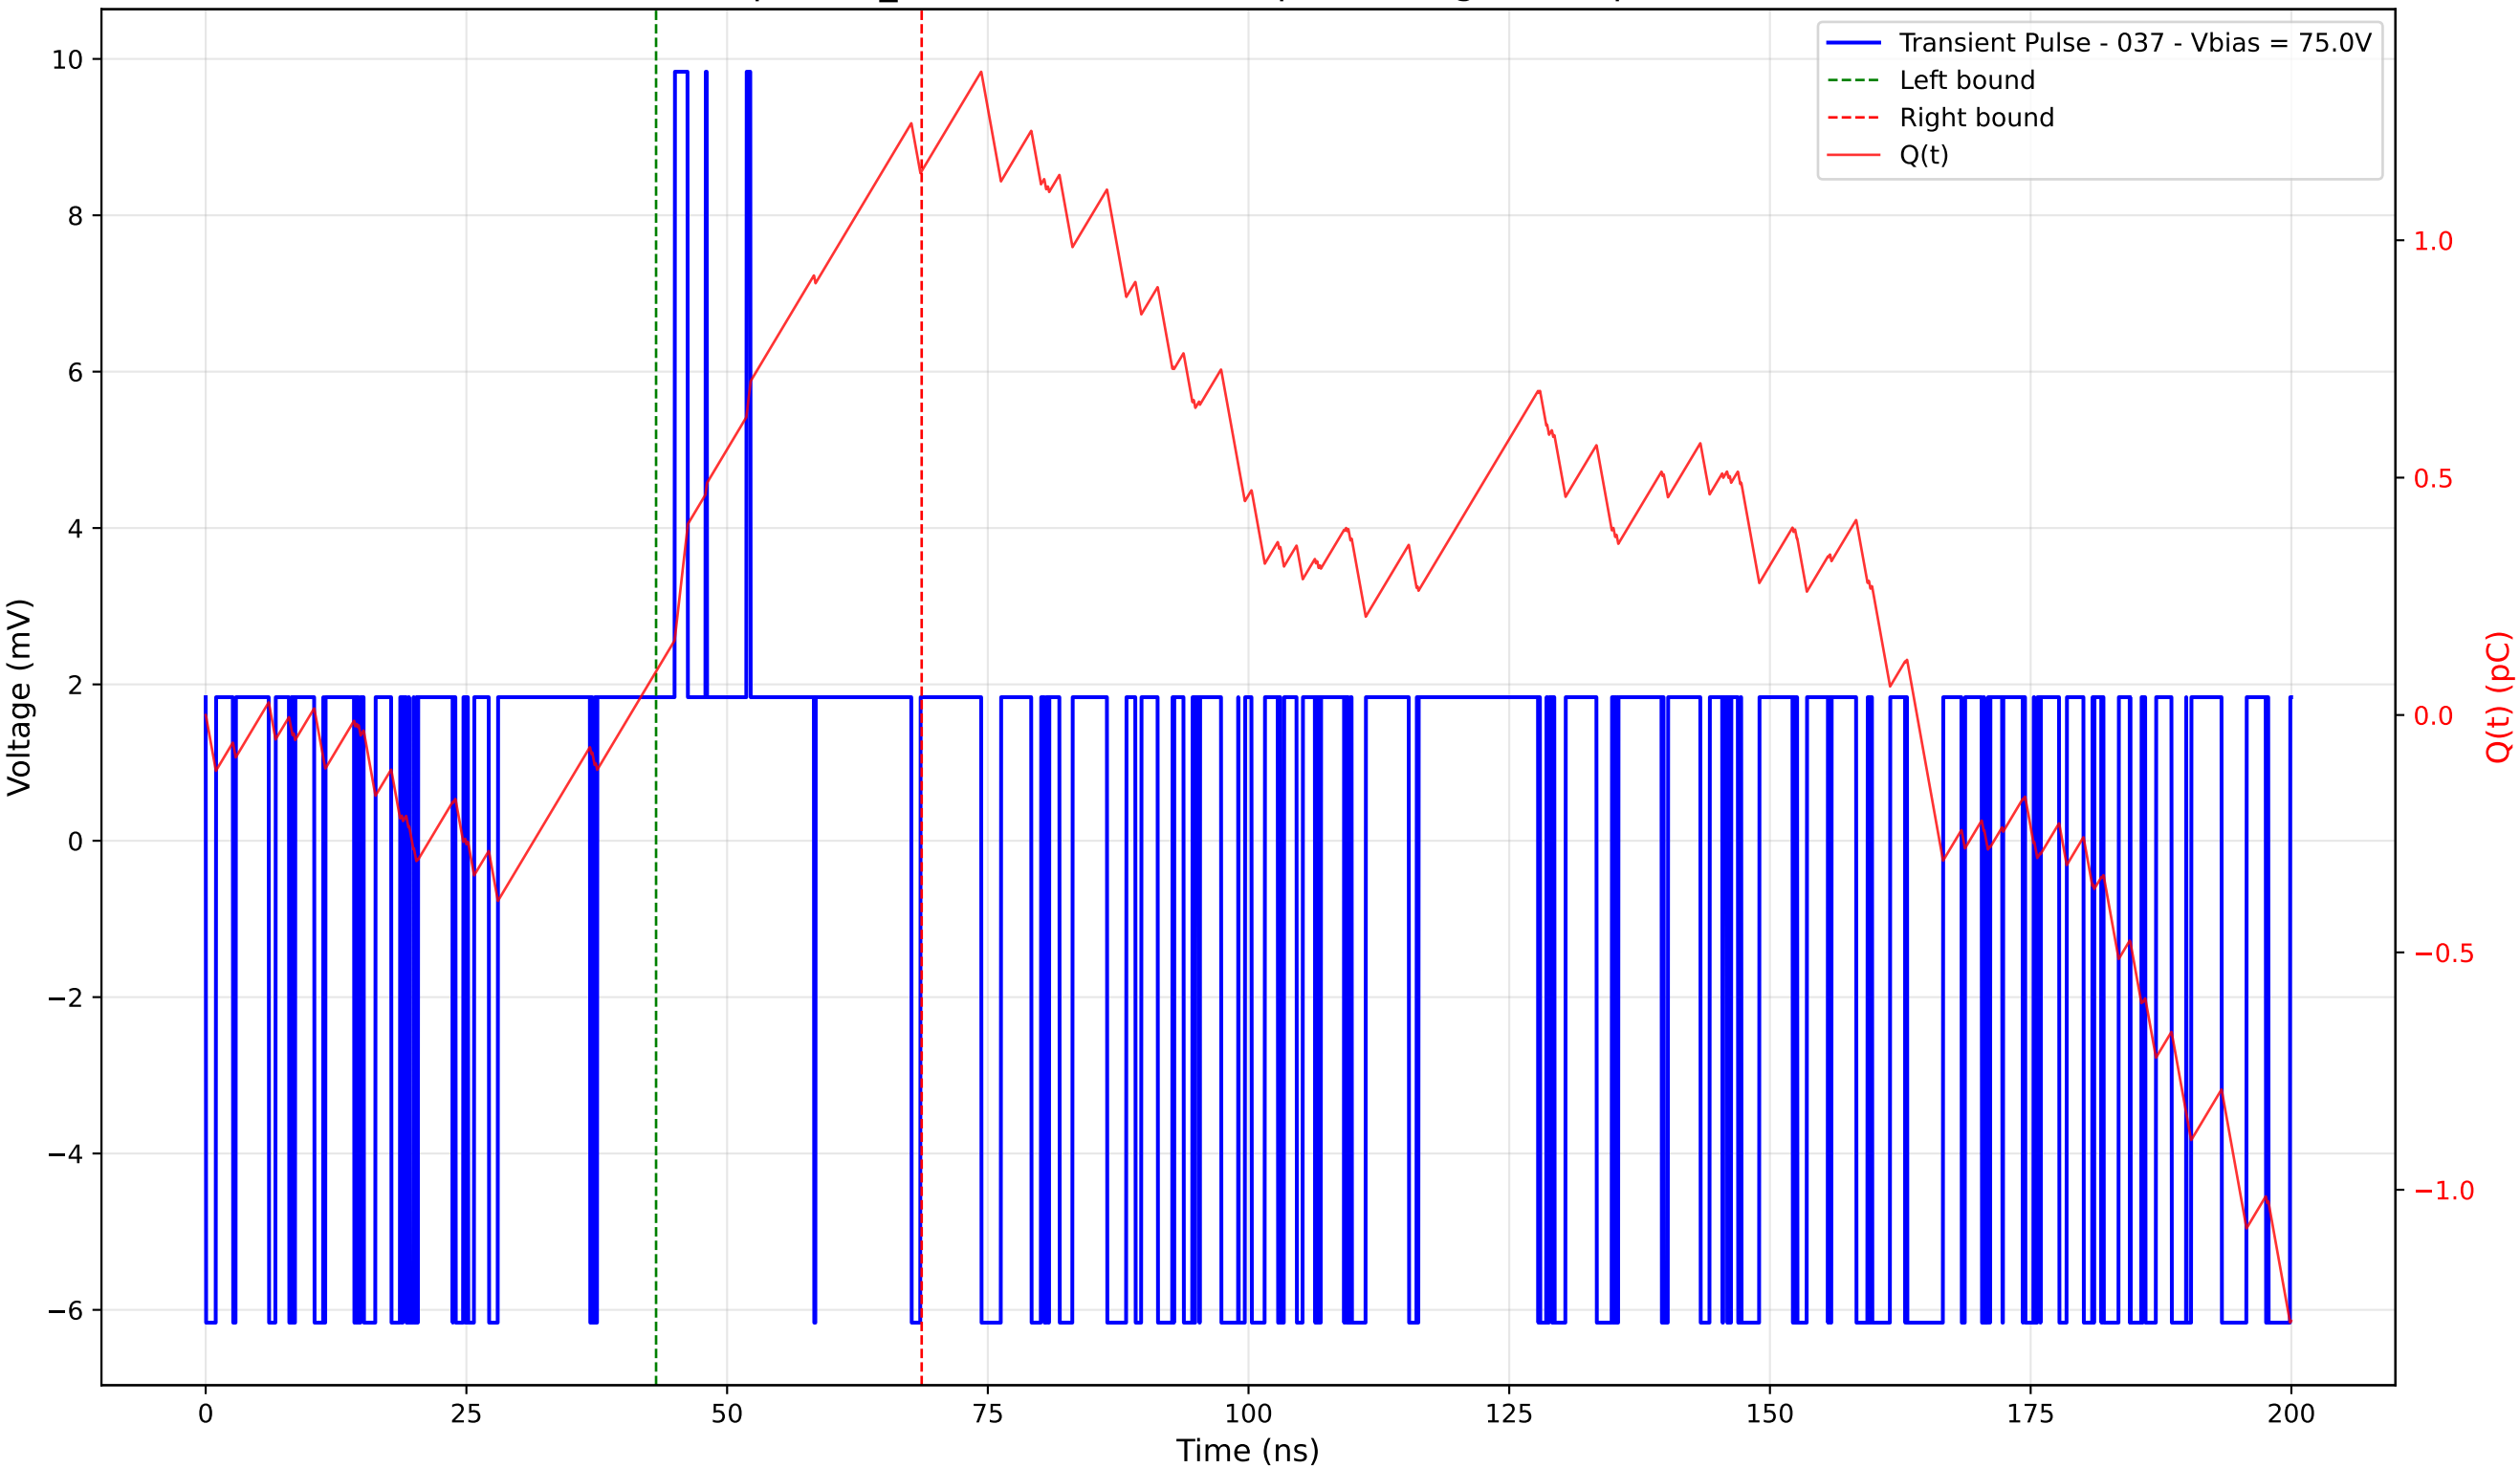


Transient Pulse - Sample: TD_4004 - Position: 15.0 μm - Charge: 1.94 pC - Rise Time: 0.00 ns (N/A)

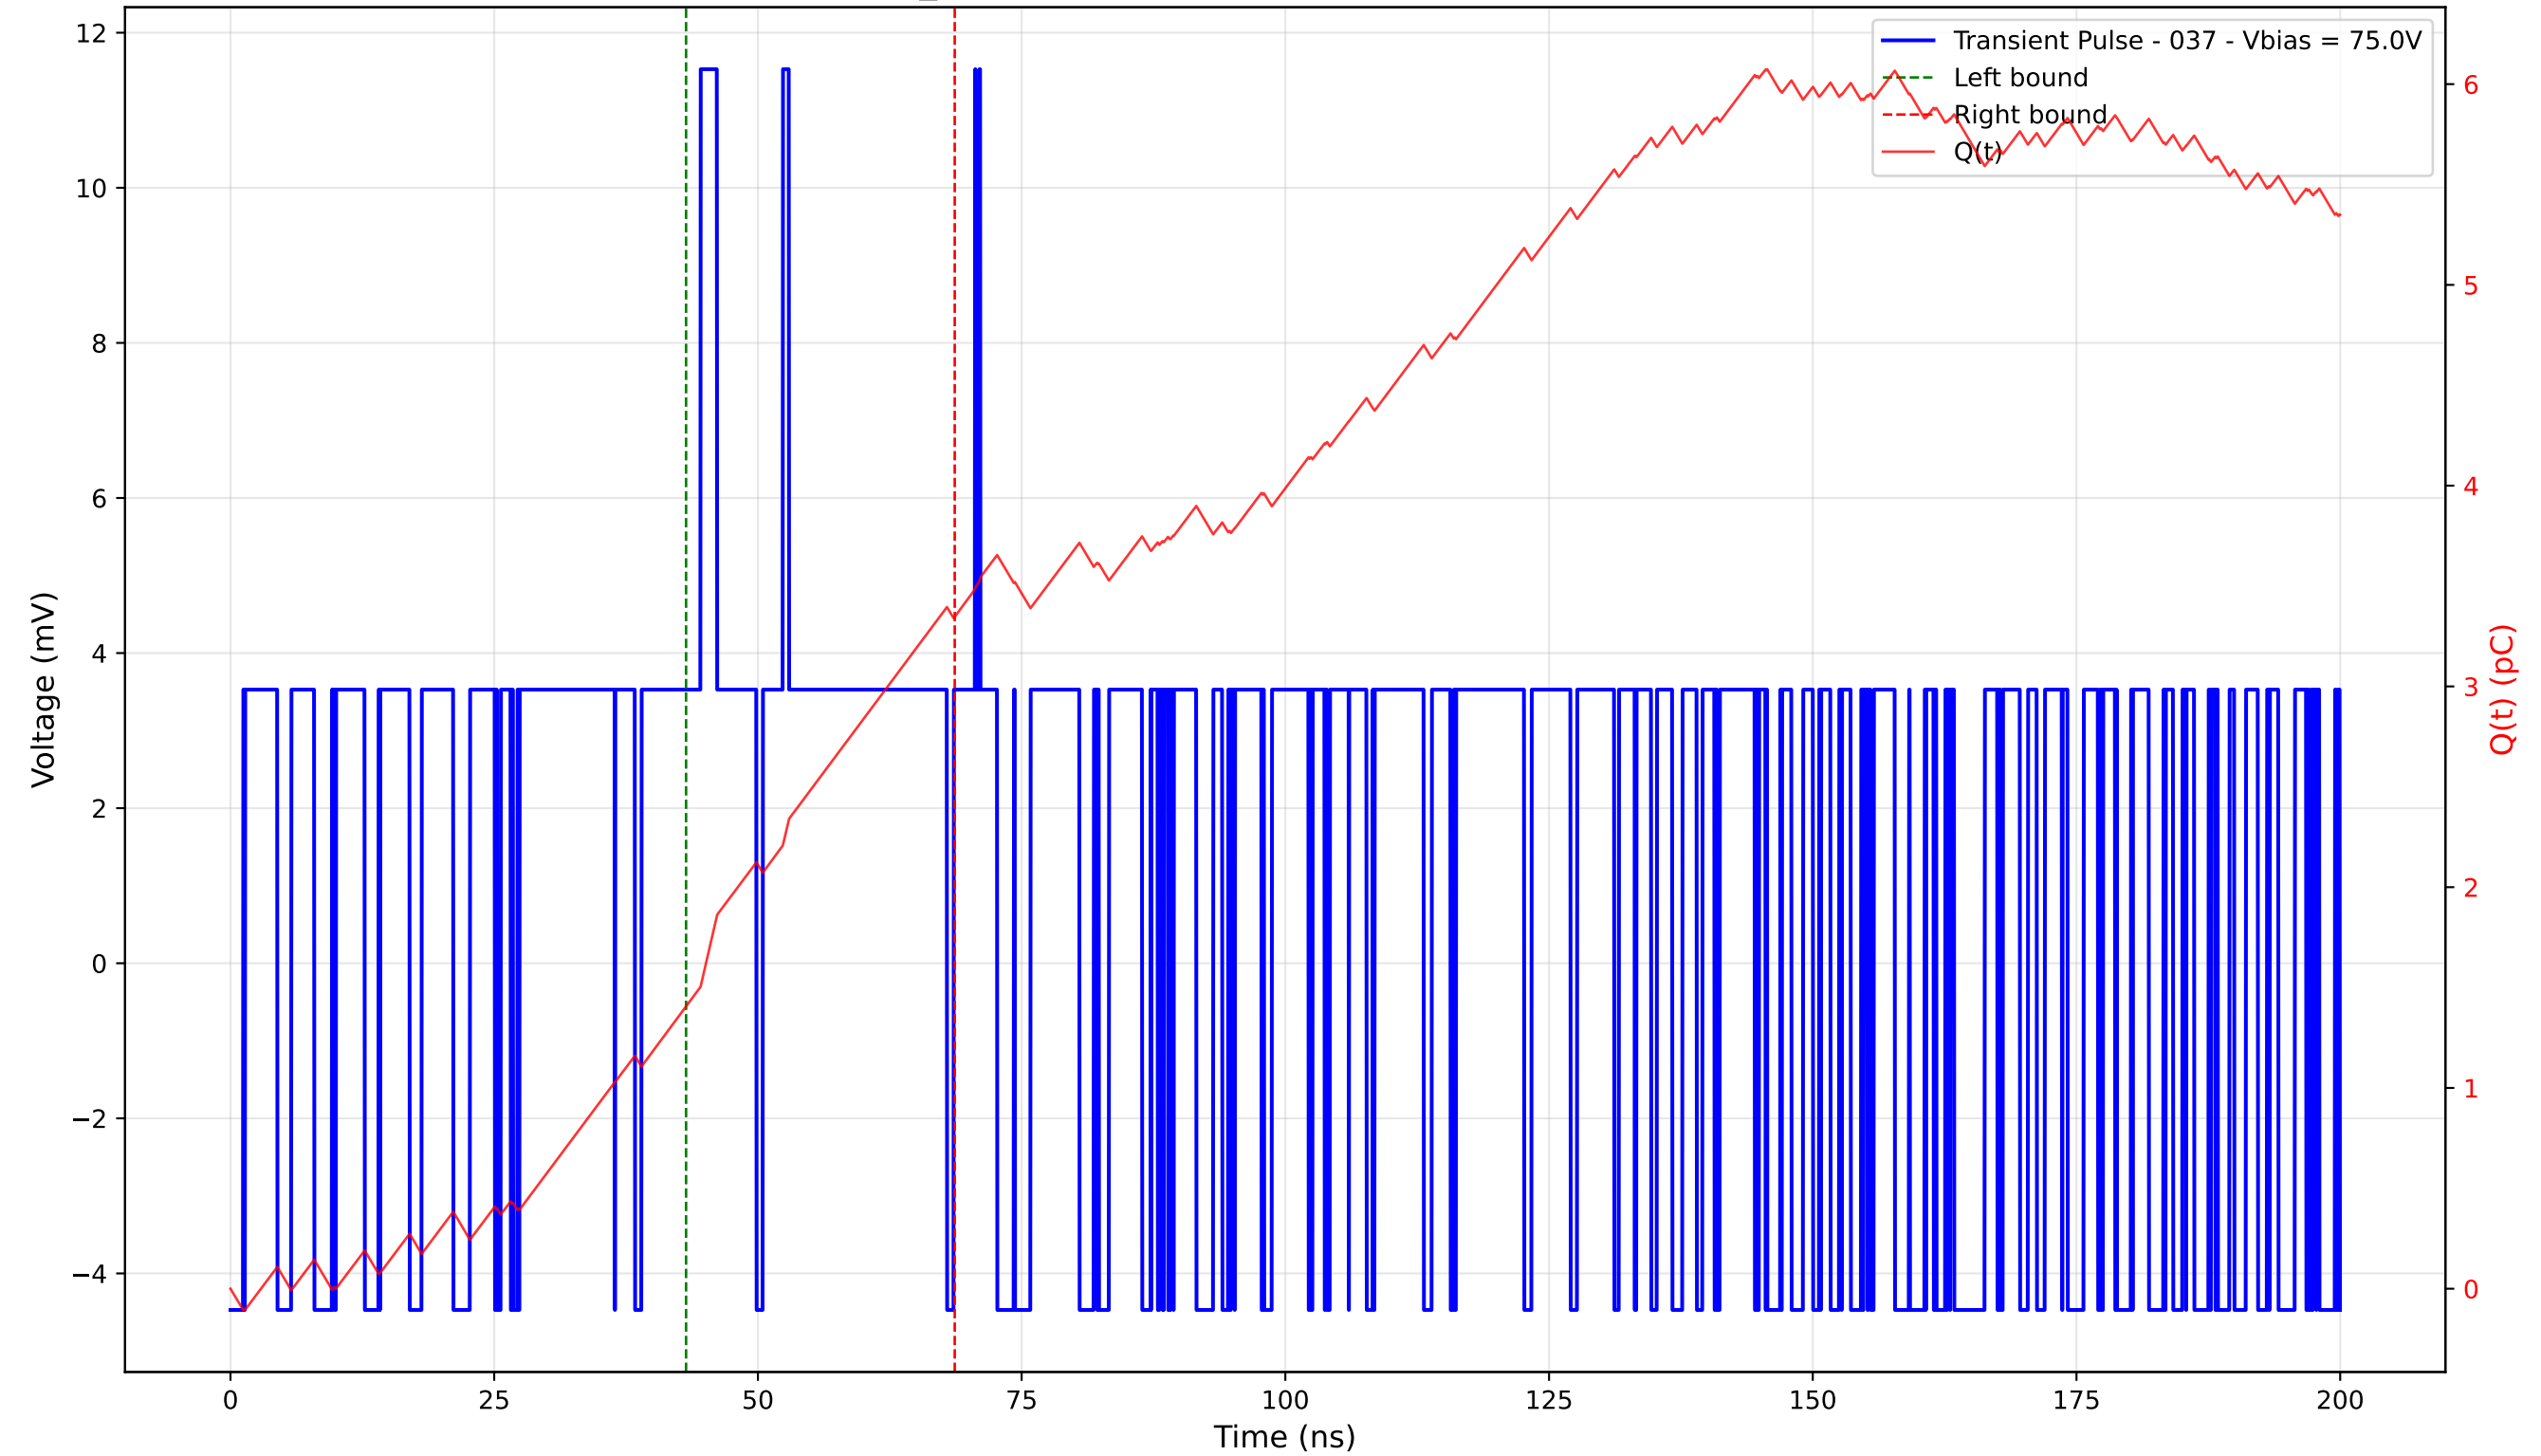


Transient Pulse - Sample: TD_4004 - Position: 20.0 μm - Charge: 1.82 pC - Rise Time: 0.00 ns (N/A)

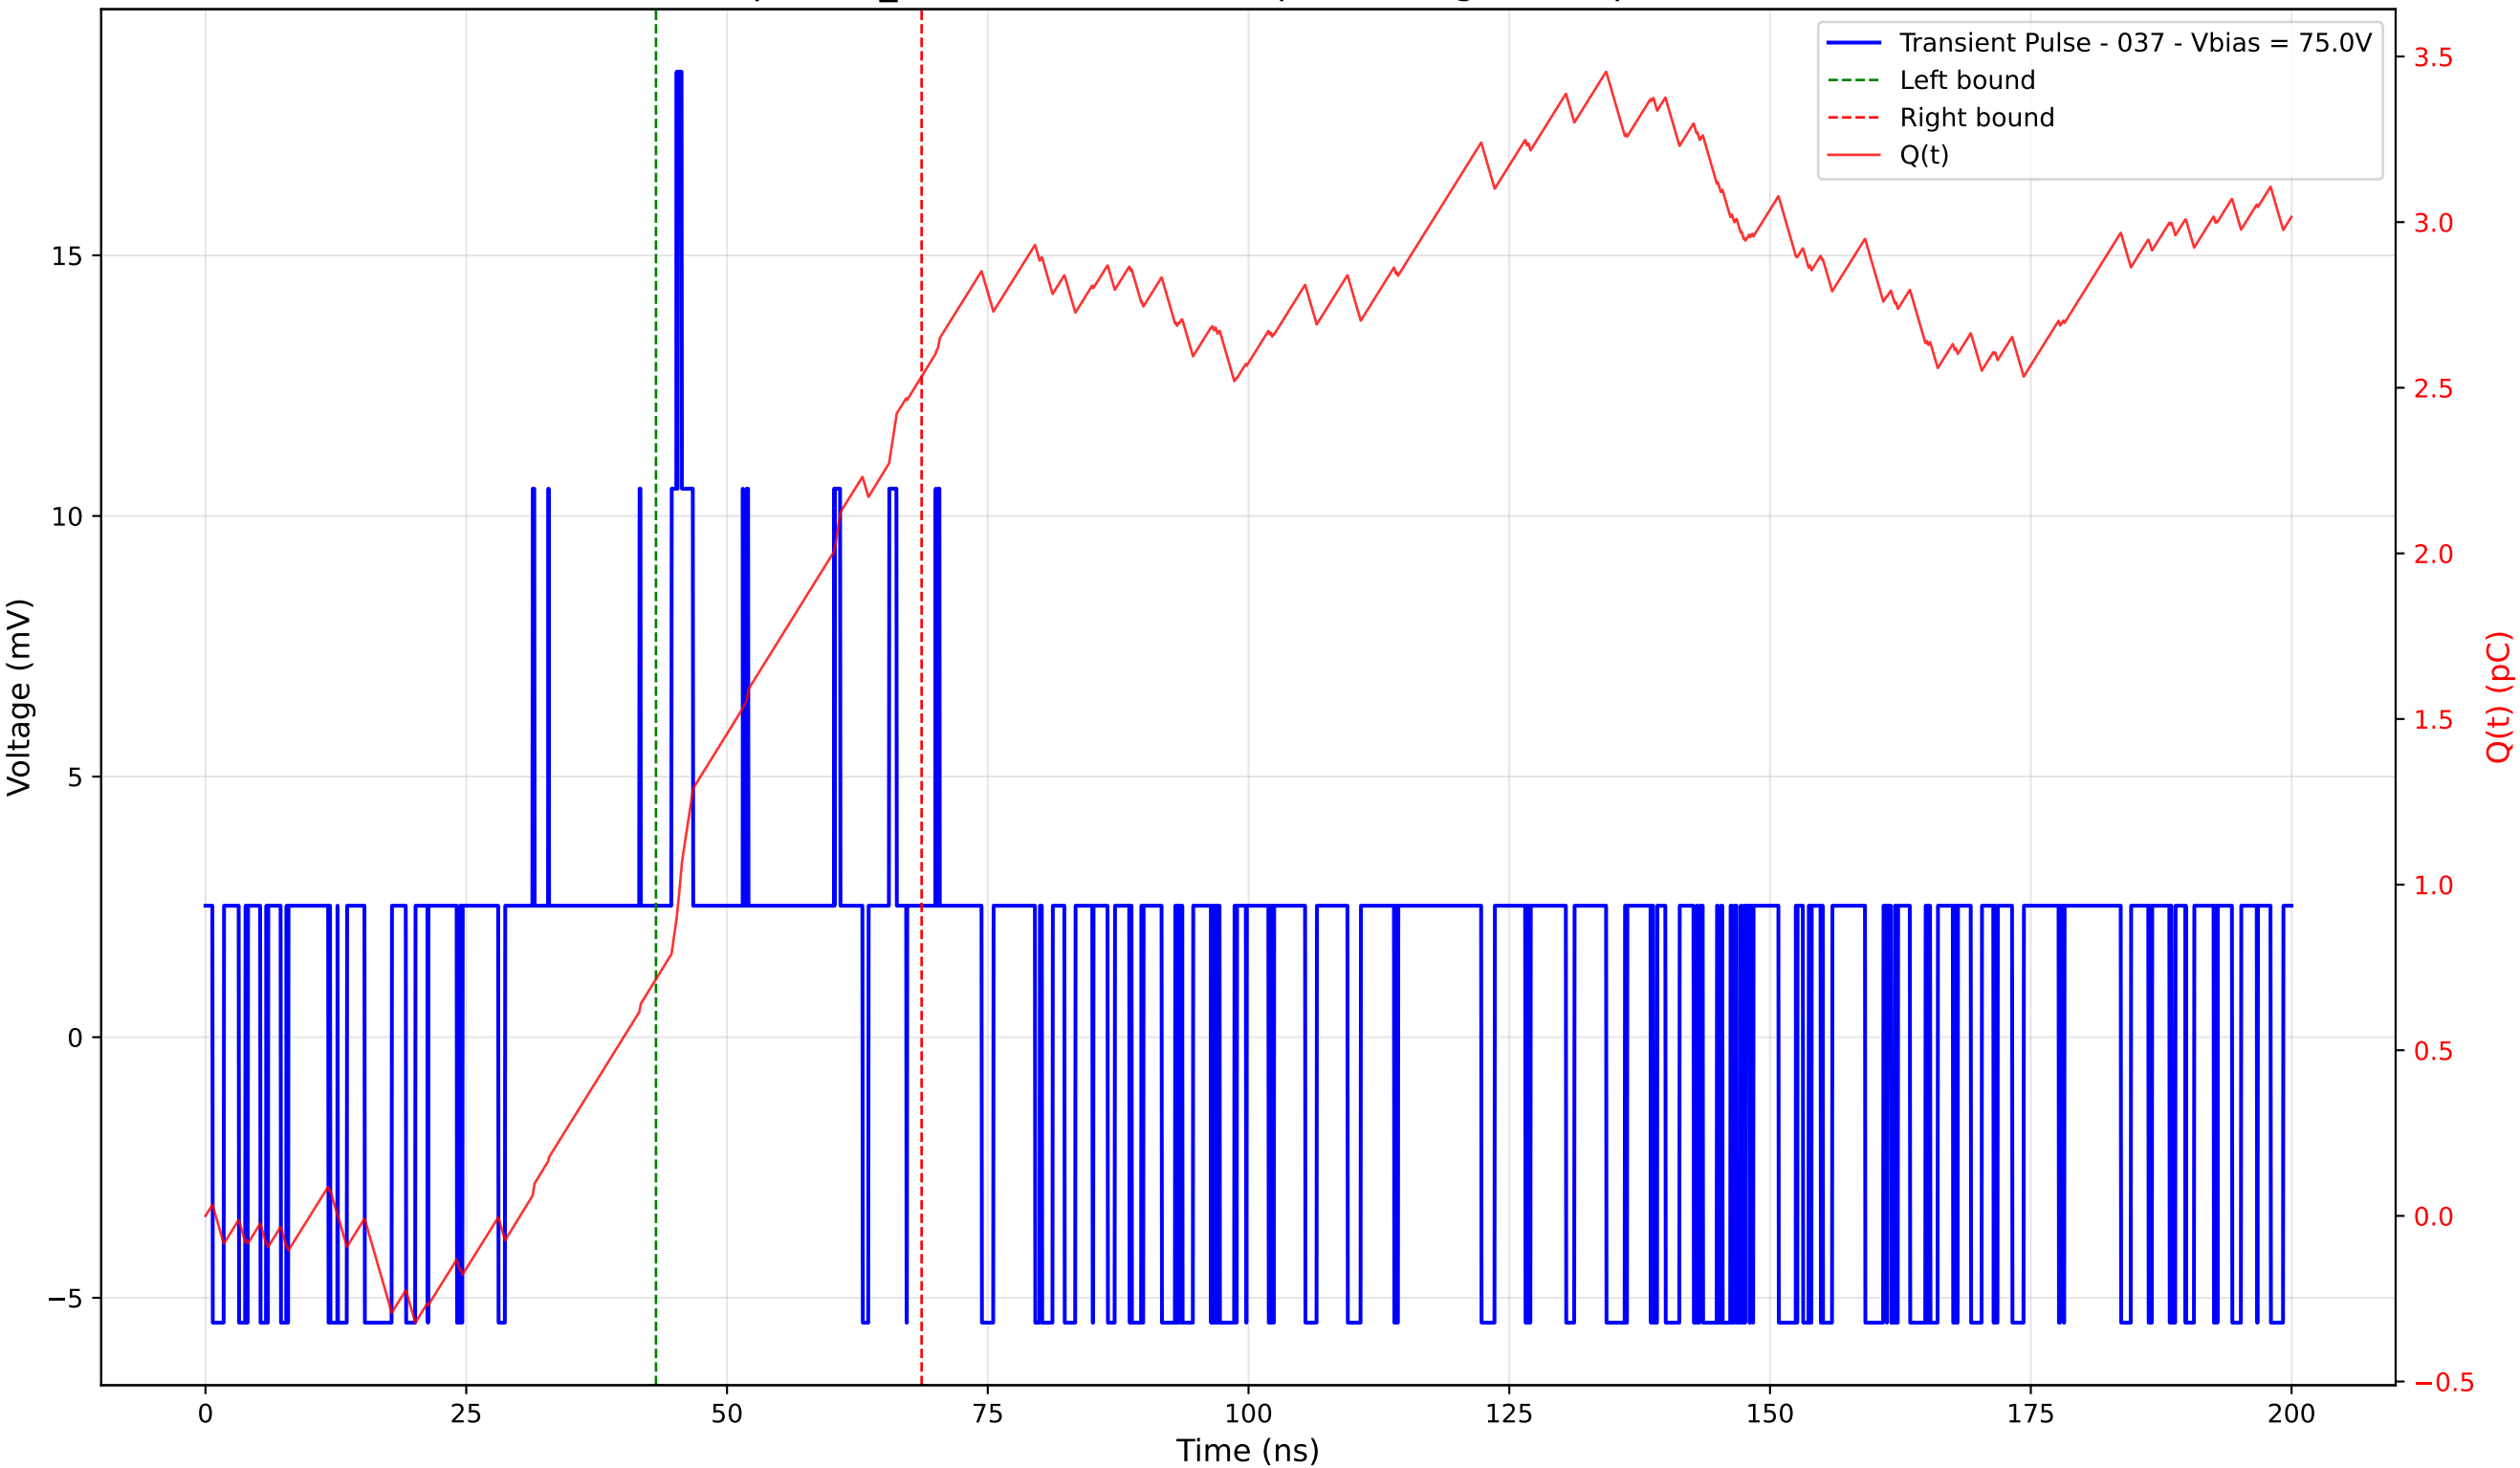


Transient Pulse - Sample: TD_4004 - Position: 25.0 μm - Charge: 2.31 pC - Rise Time: 0.00 ns (N/A)

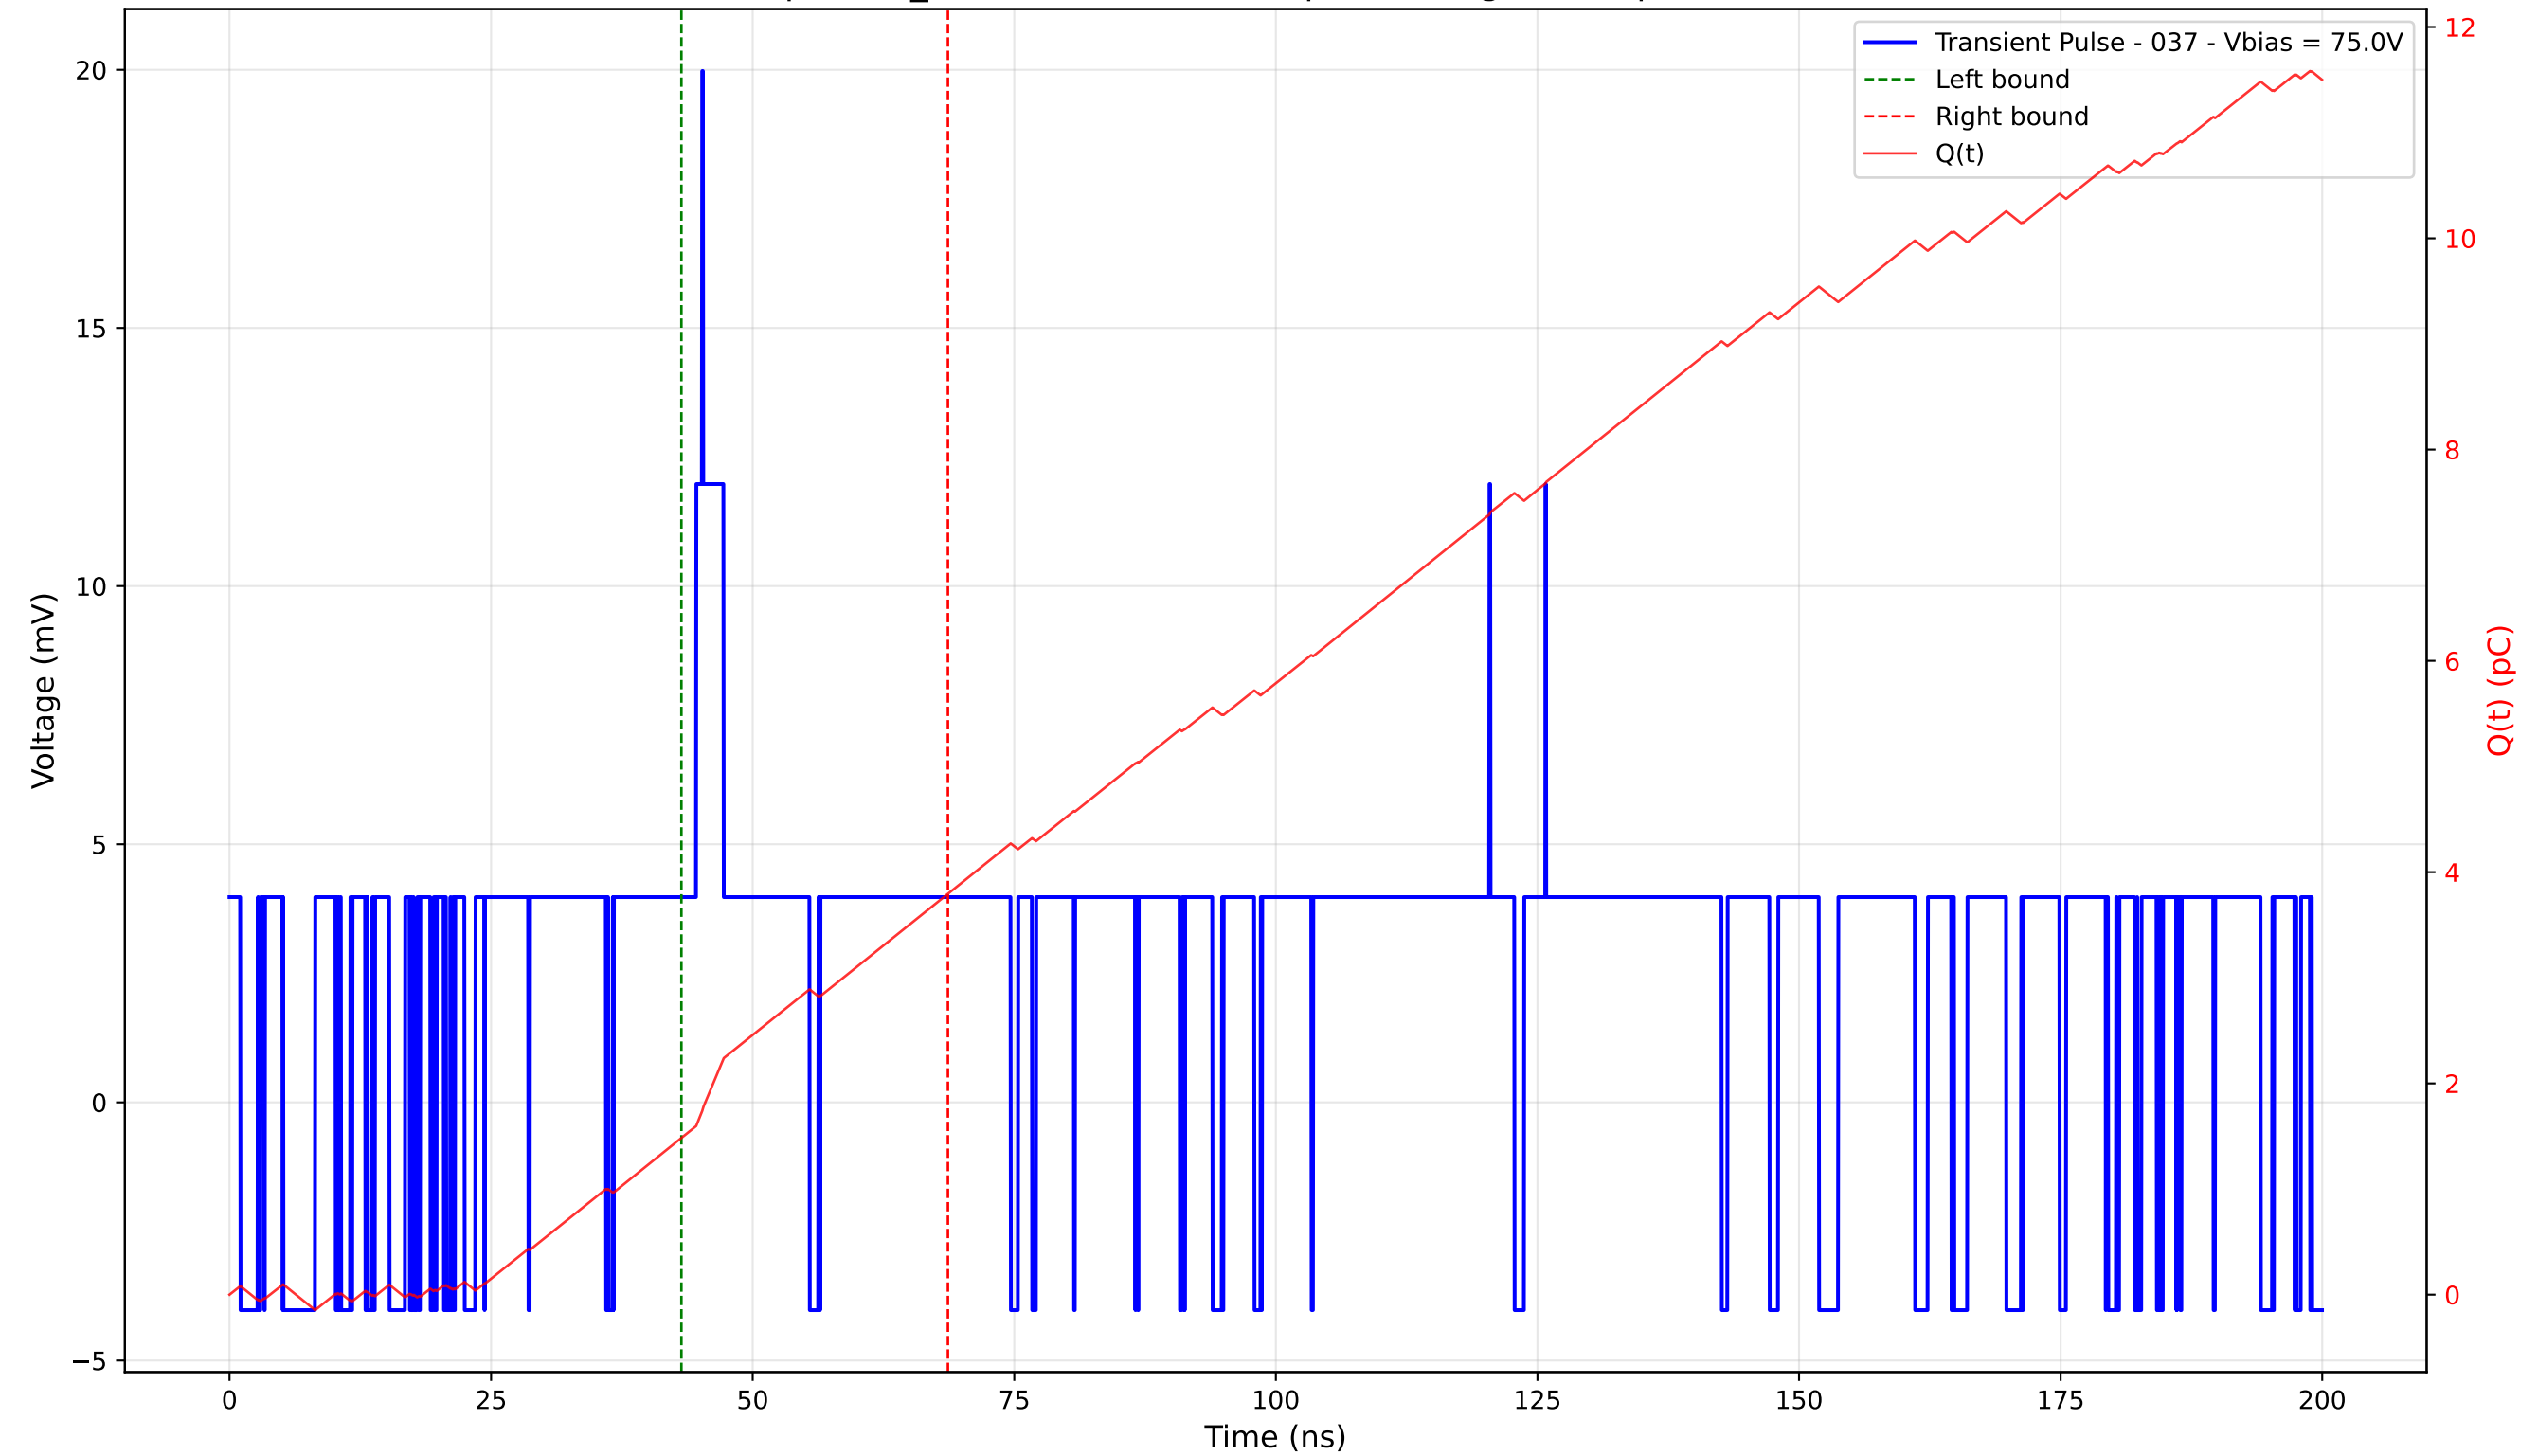


Transient Pulse - Sample: TD_4004 - Position: 30.0 μm - Charge: 1.44 pC - Rise Time: 0.62 ns

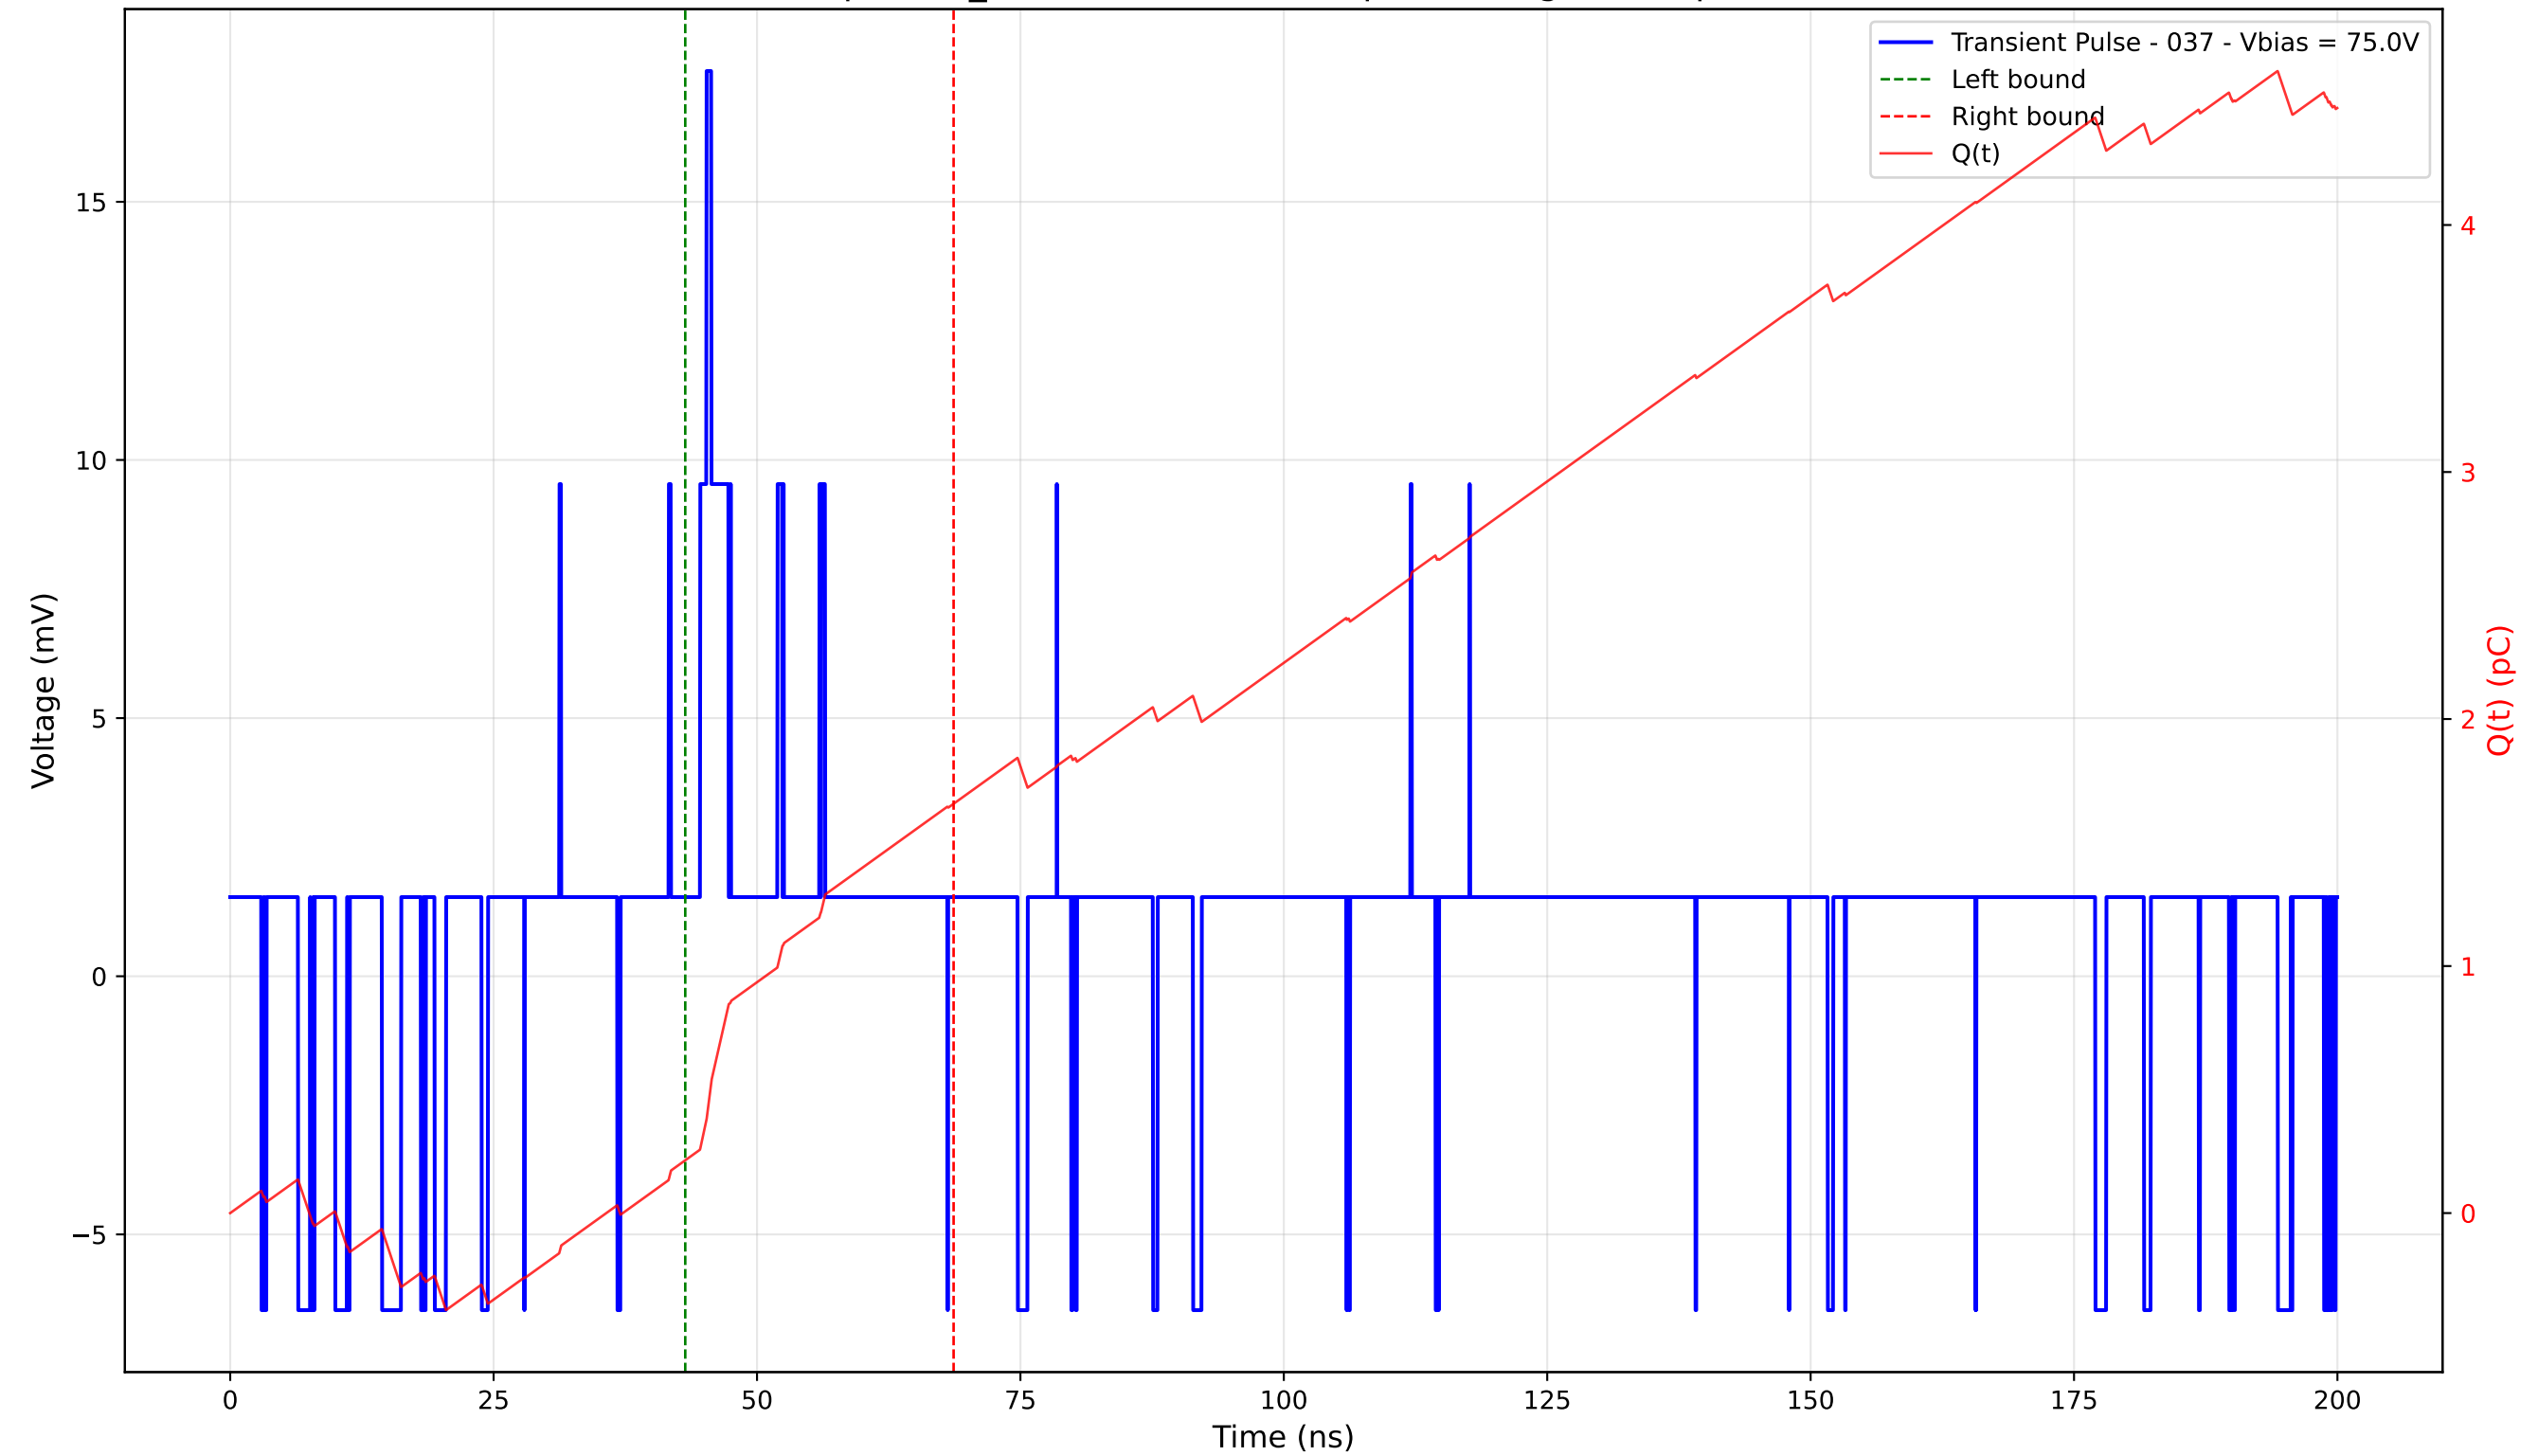


Transient Pulse - Sample: TD_4004 - Position: 35.0 μm - Charge: 2.72 pC - Rise Time: 0.00 ns (N/A)

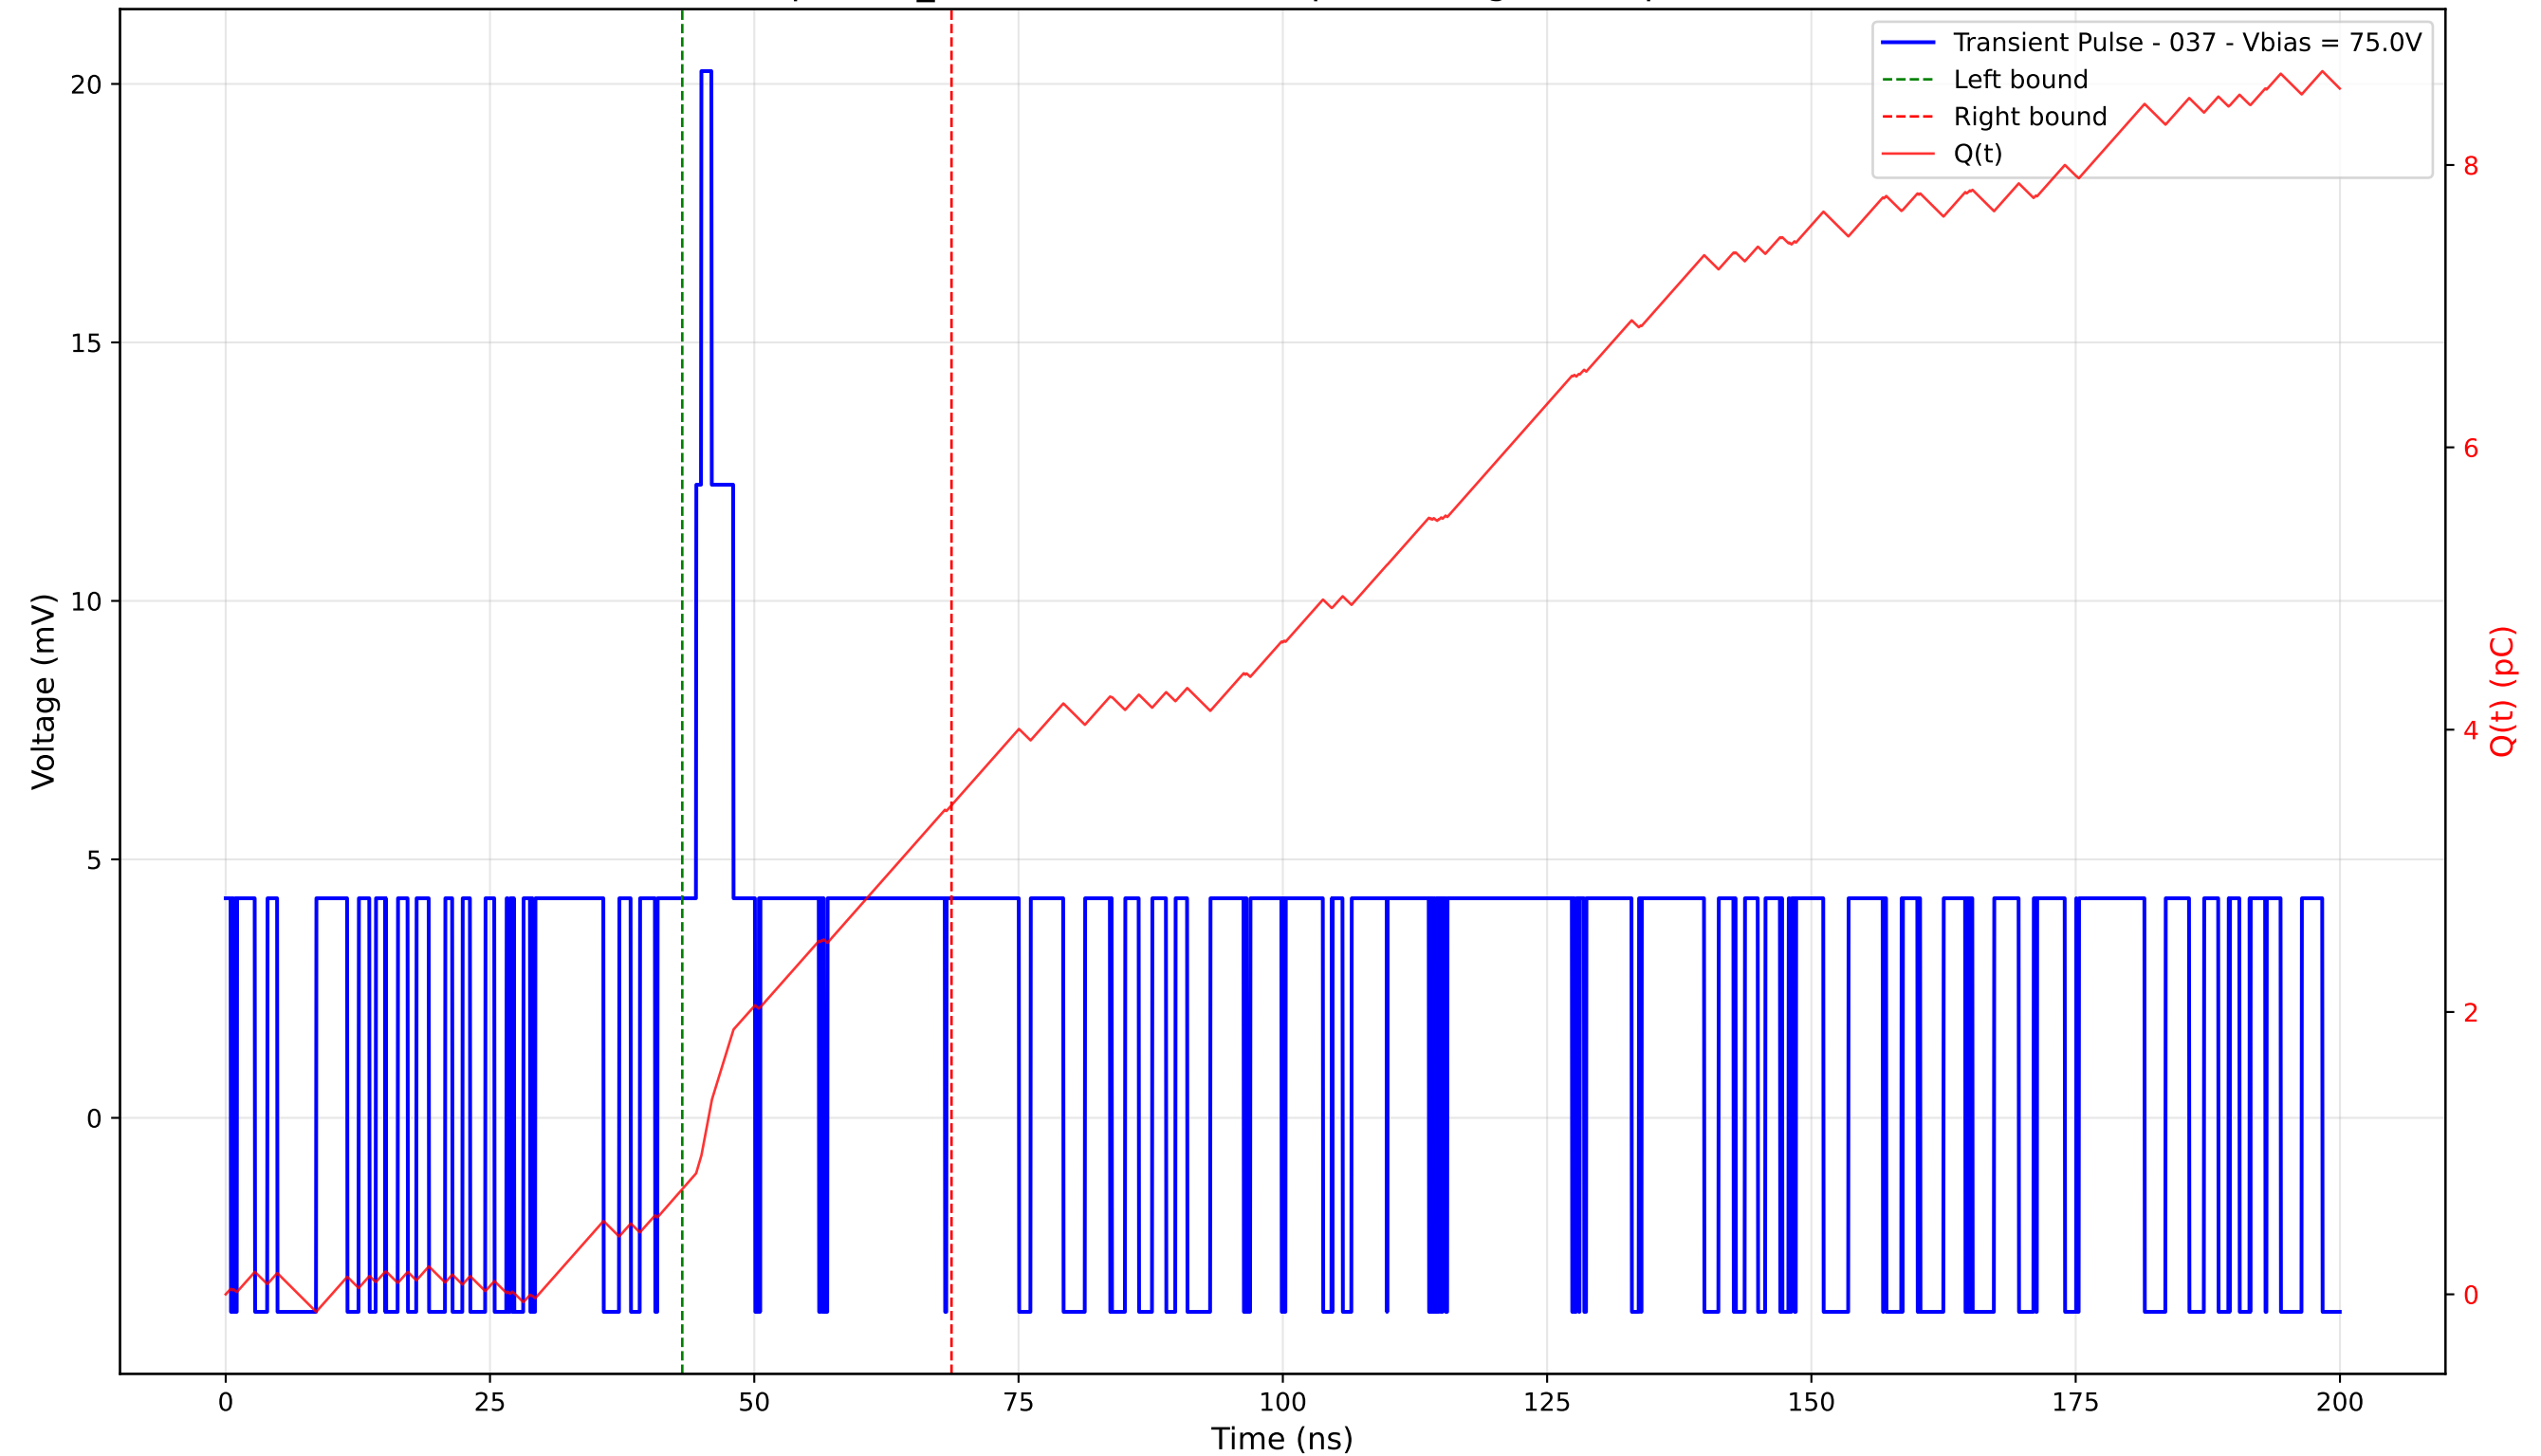


Transient Pulse - Sample: TD_4004 - Position: 40.0 μm - Charge: 1.12 pC - Rise Time: 0.74 ns

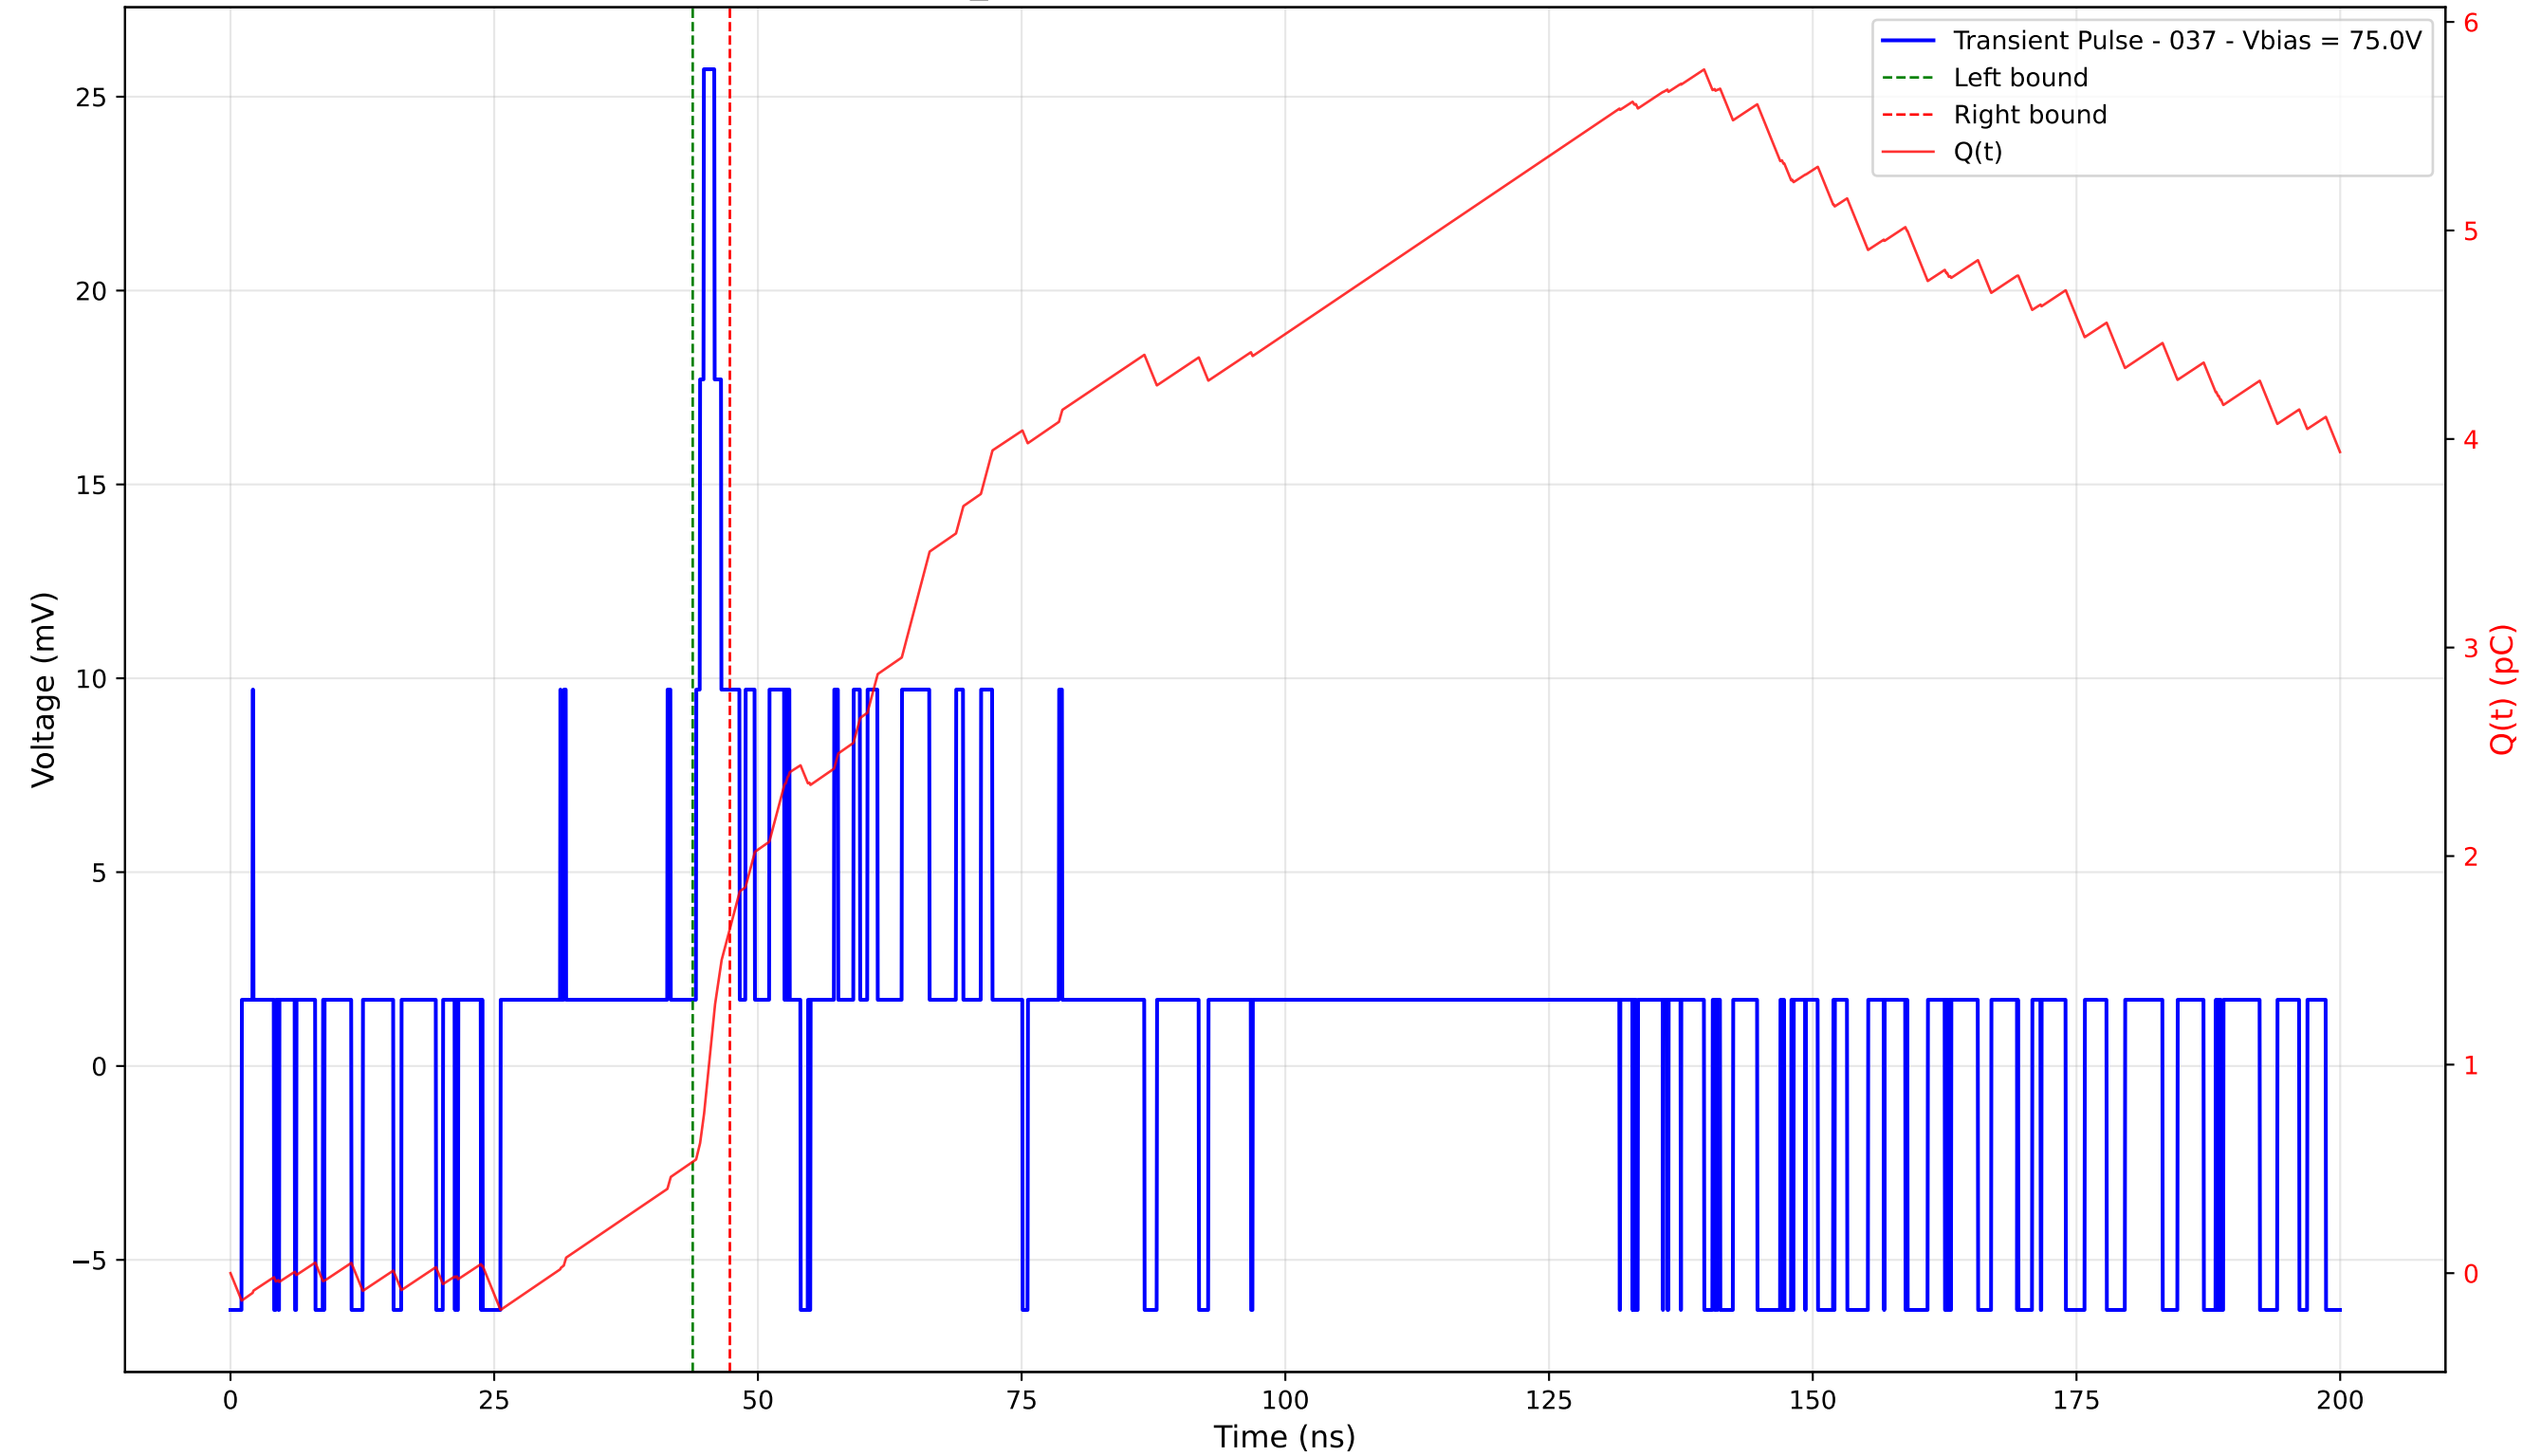


Transient Pulse - Sample: TD_4004 - Position: 45.0 μm - Charge: 1.96 pC - Rise Time: 1.01 ns

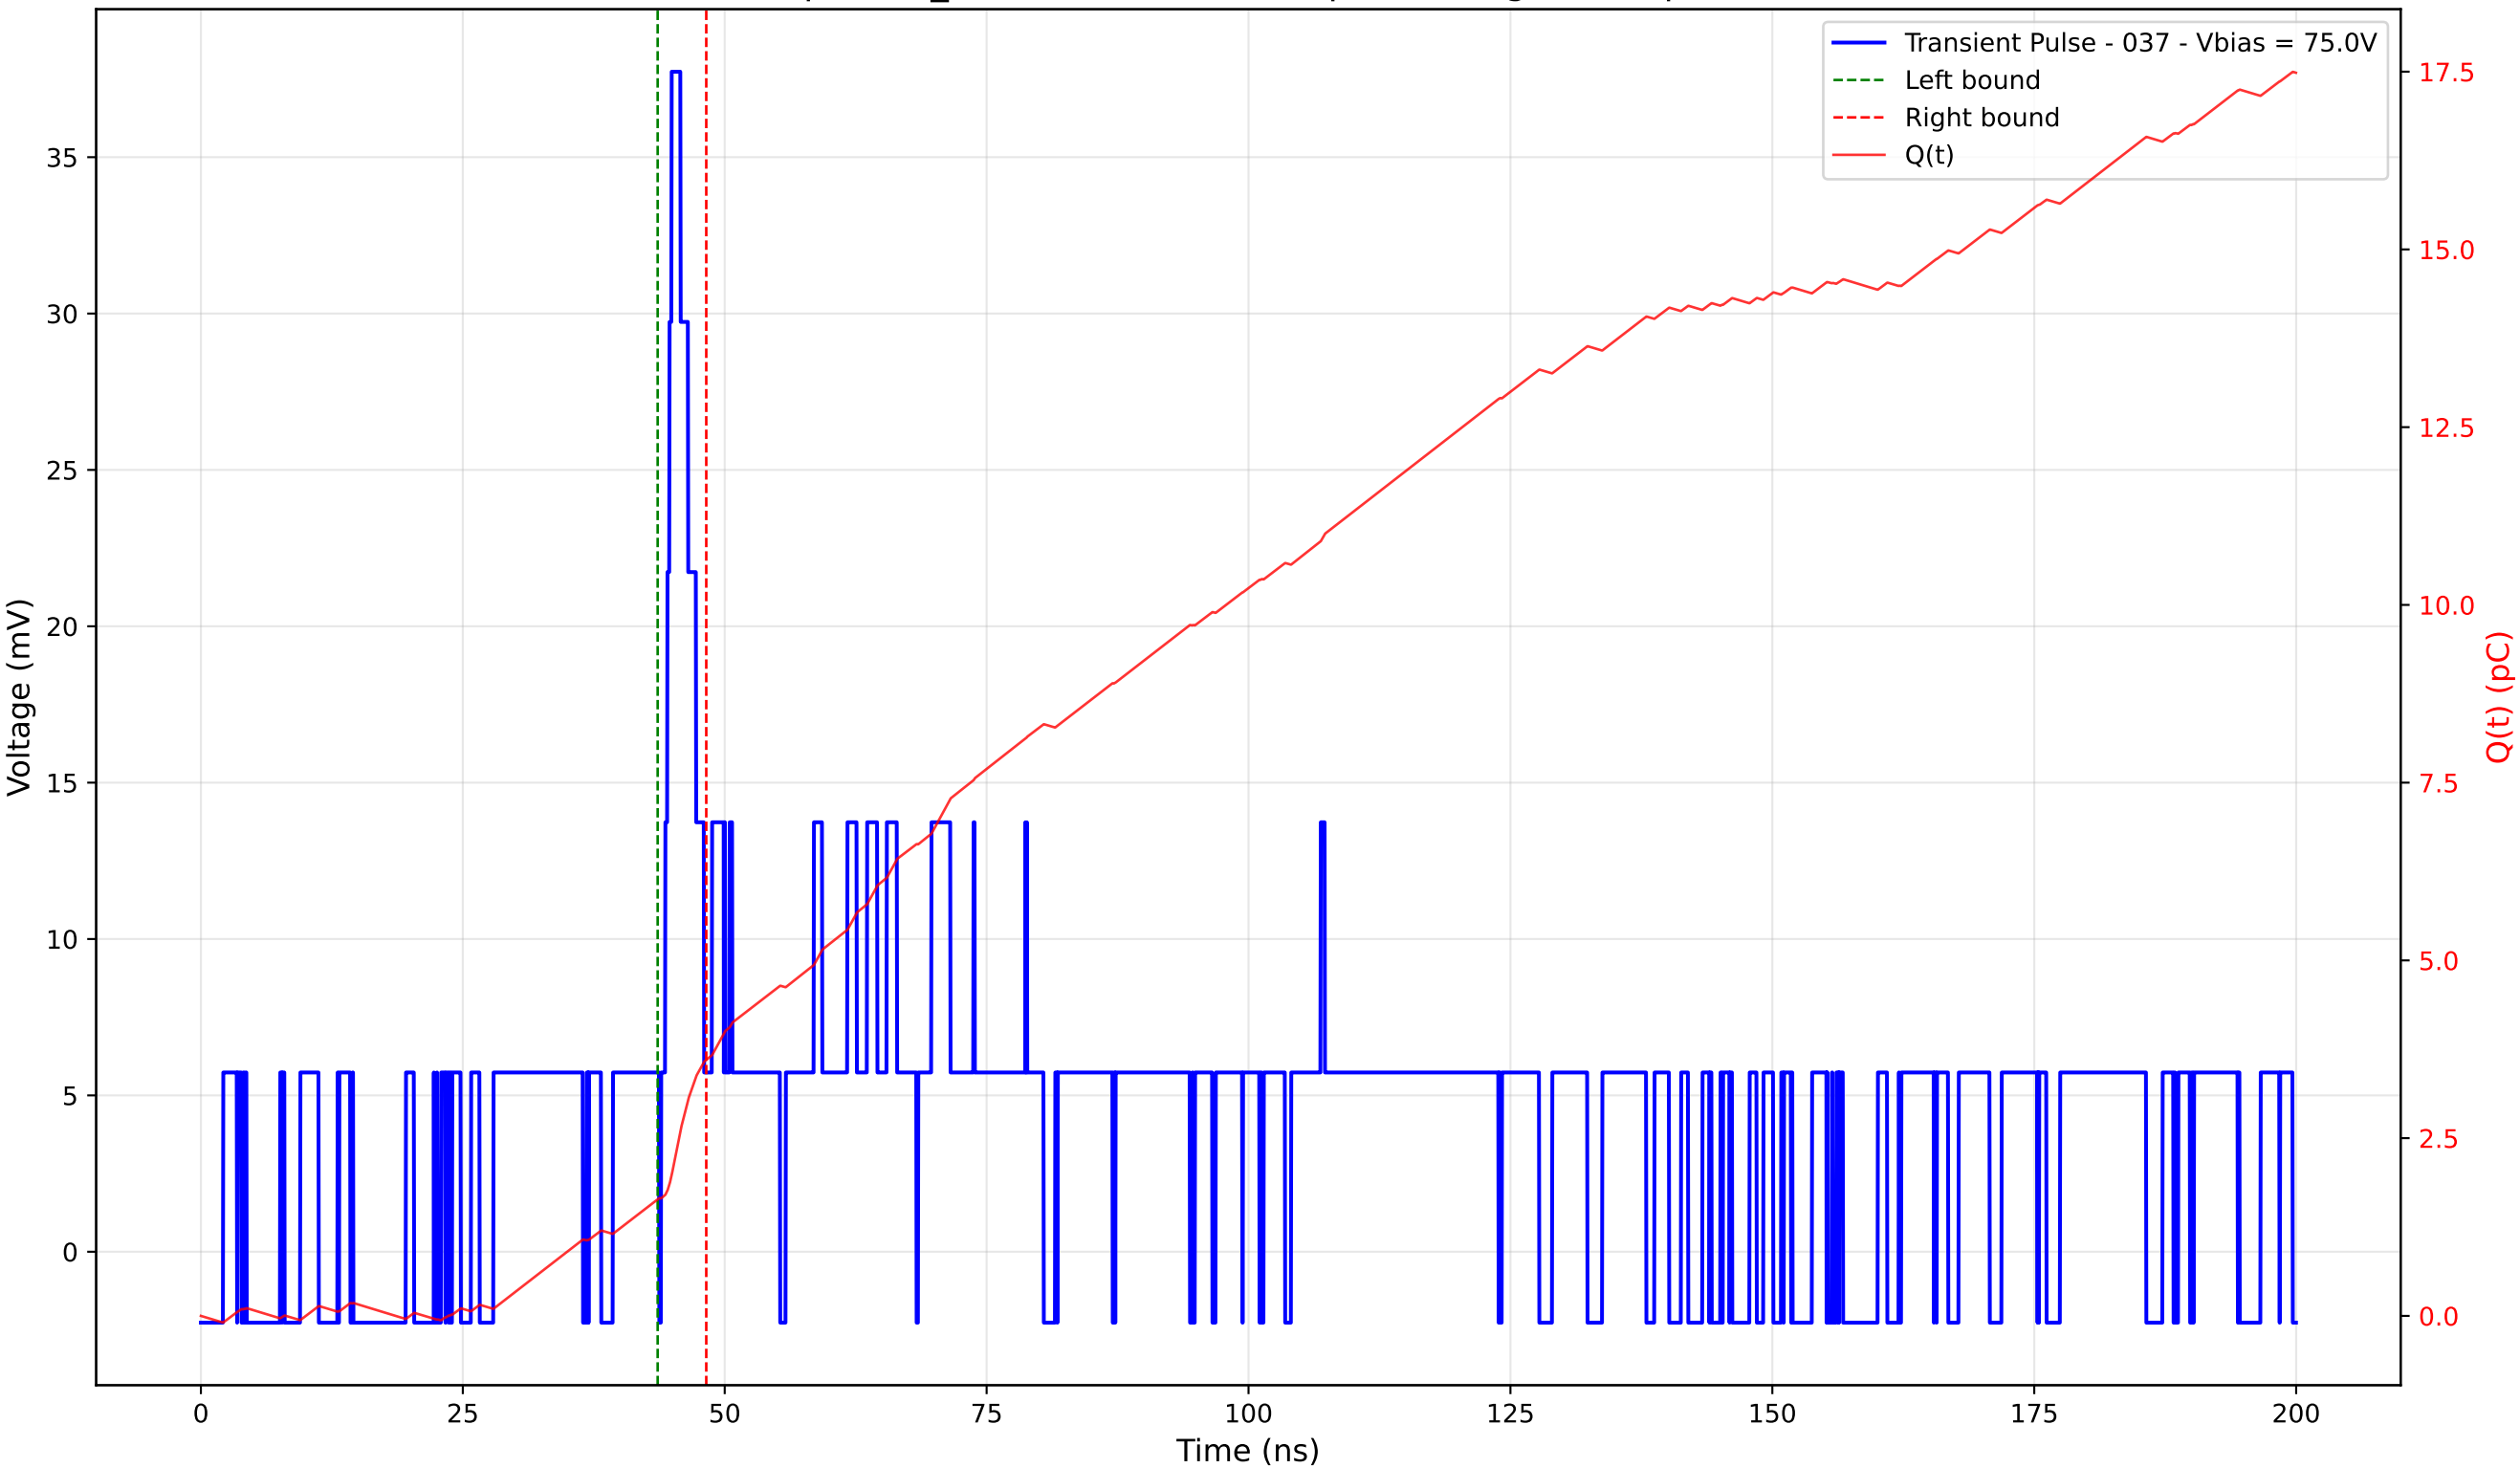


Transient Pulse - Sample: TD_4004 - Position: 50.0 μm - Charge: 2.91 pC - Rise Time: 1.01 ns

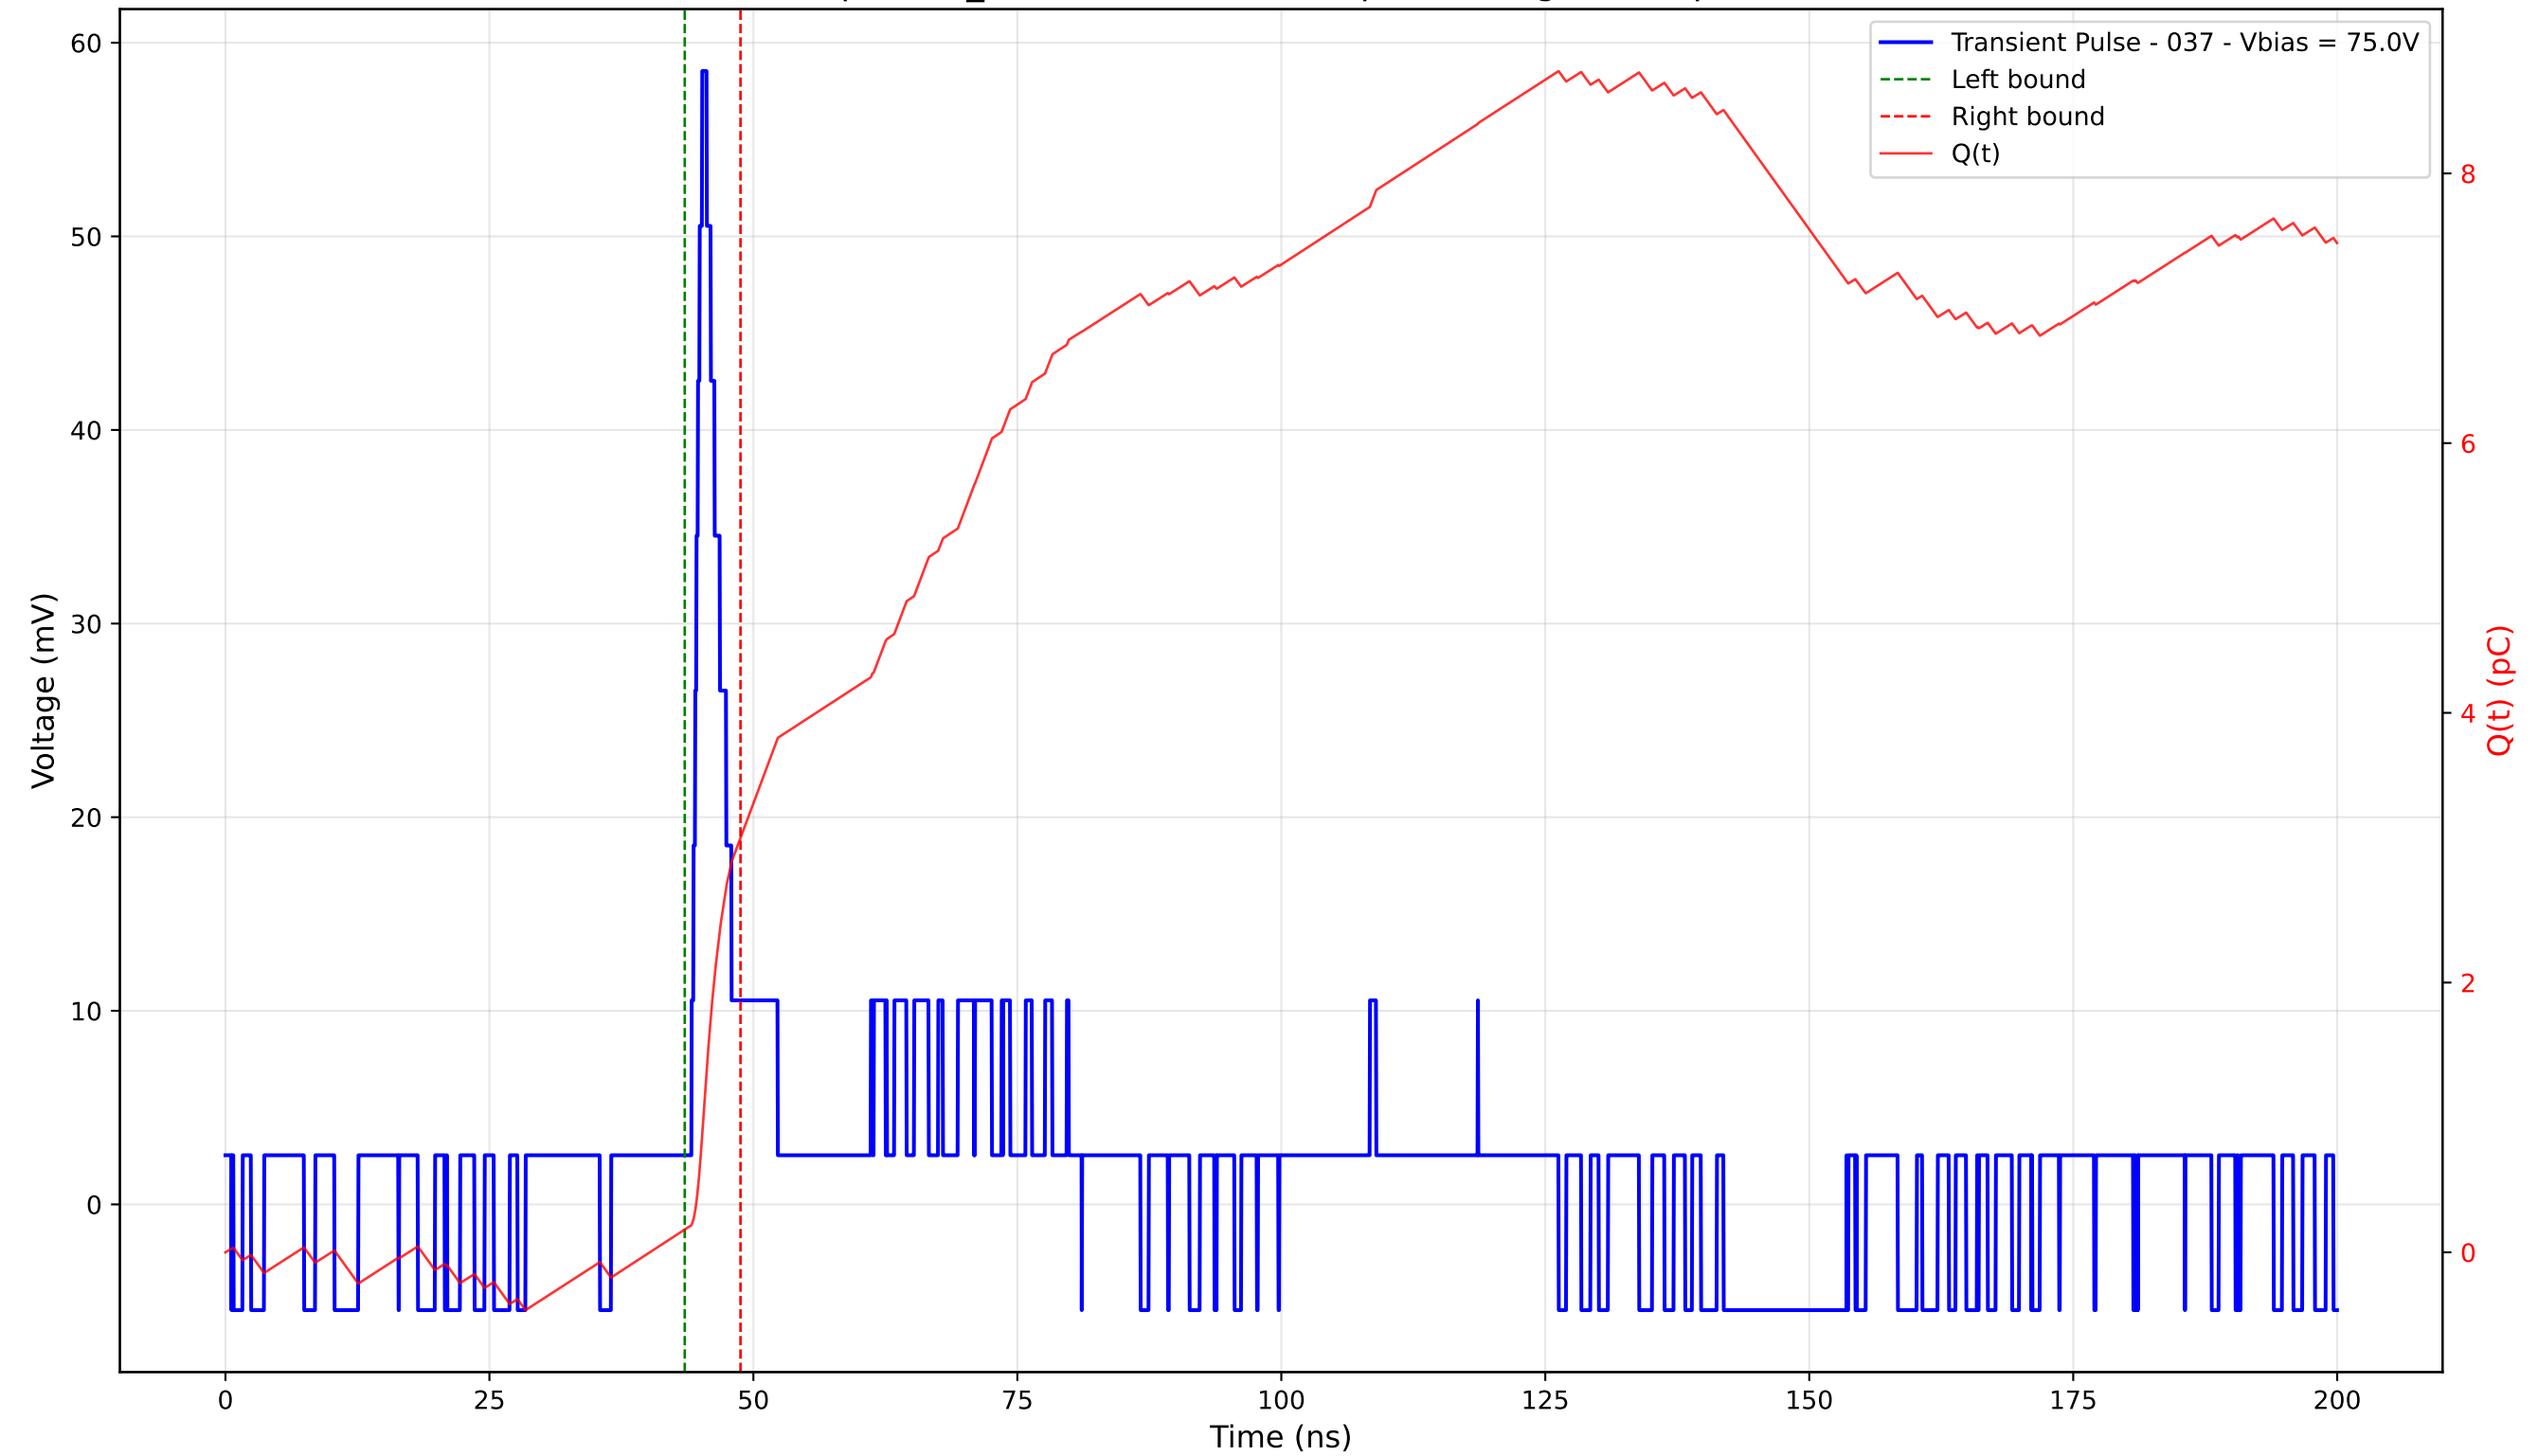


Transient Pulse - Sample: TD_4004 - Position: 55.0 μm - Charge: 5.96 pC - Rise Time: 0.96 ns

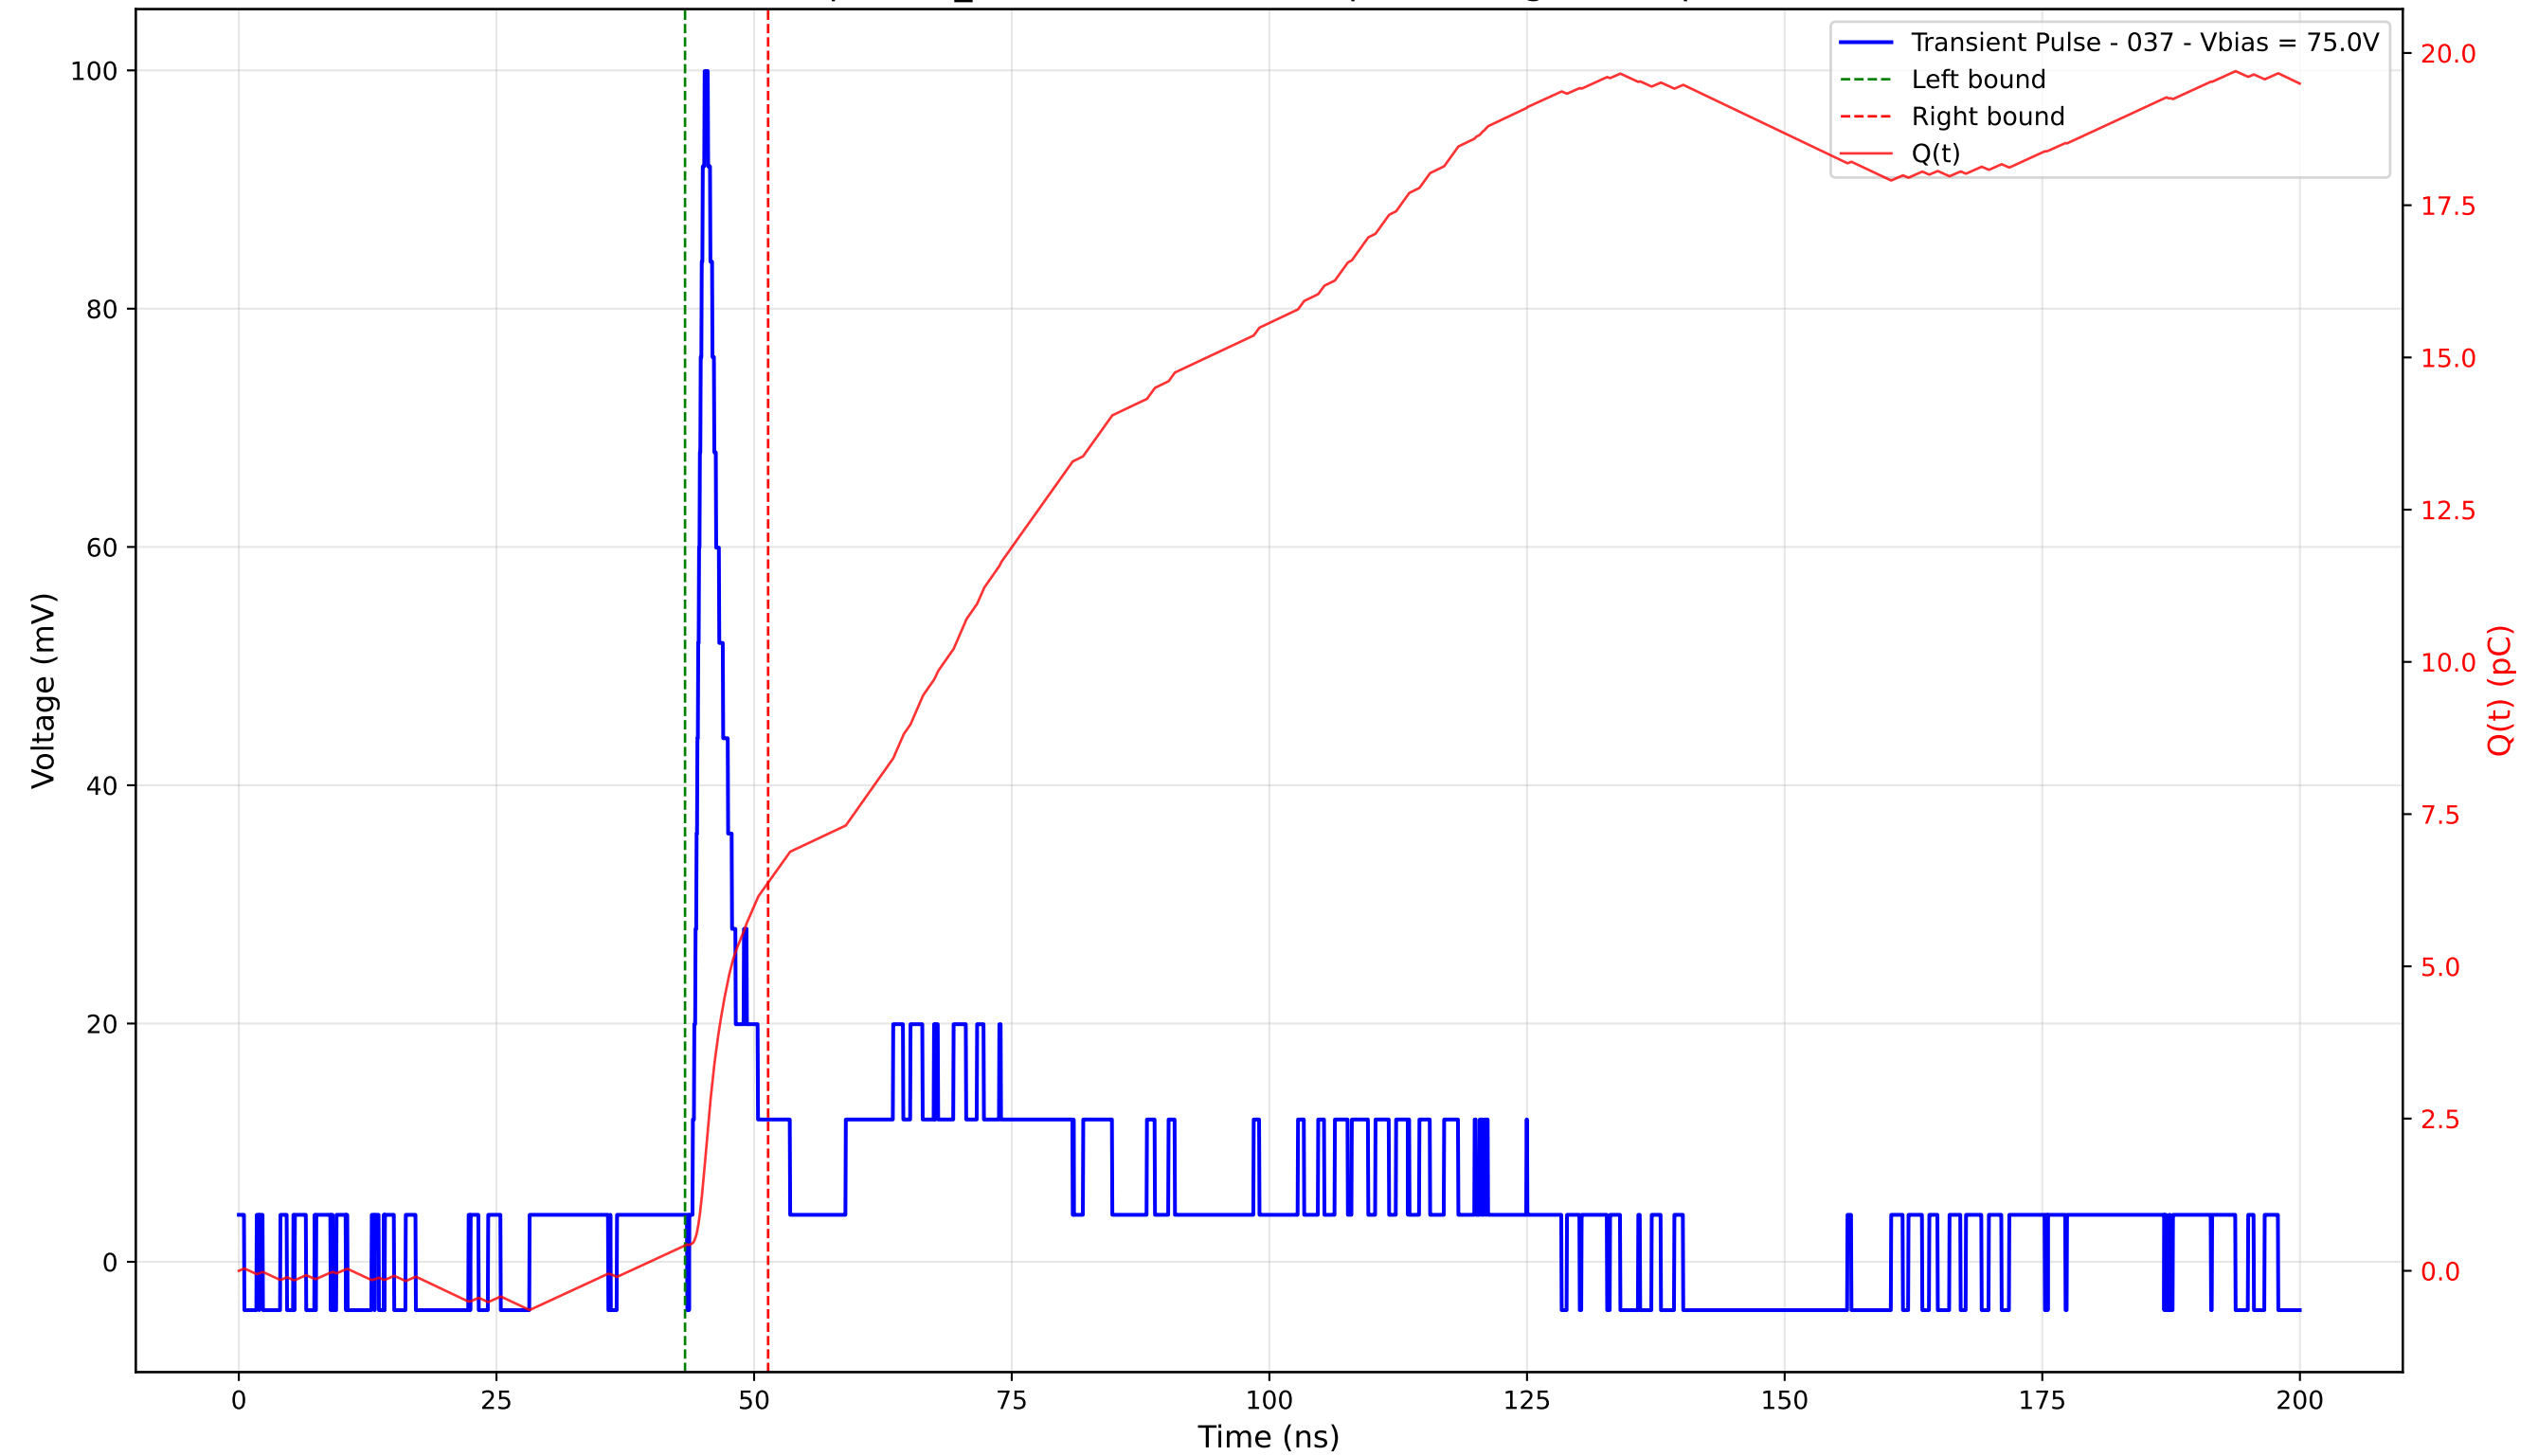


Transient Pulse - Sample: TD_4004 - Position: 60.0 μm - Charge: 10.18 pC - Rise Time: 1.05 ns

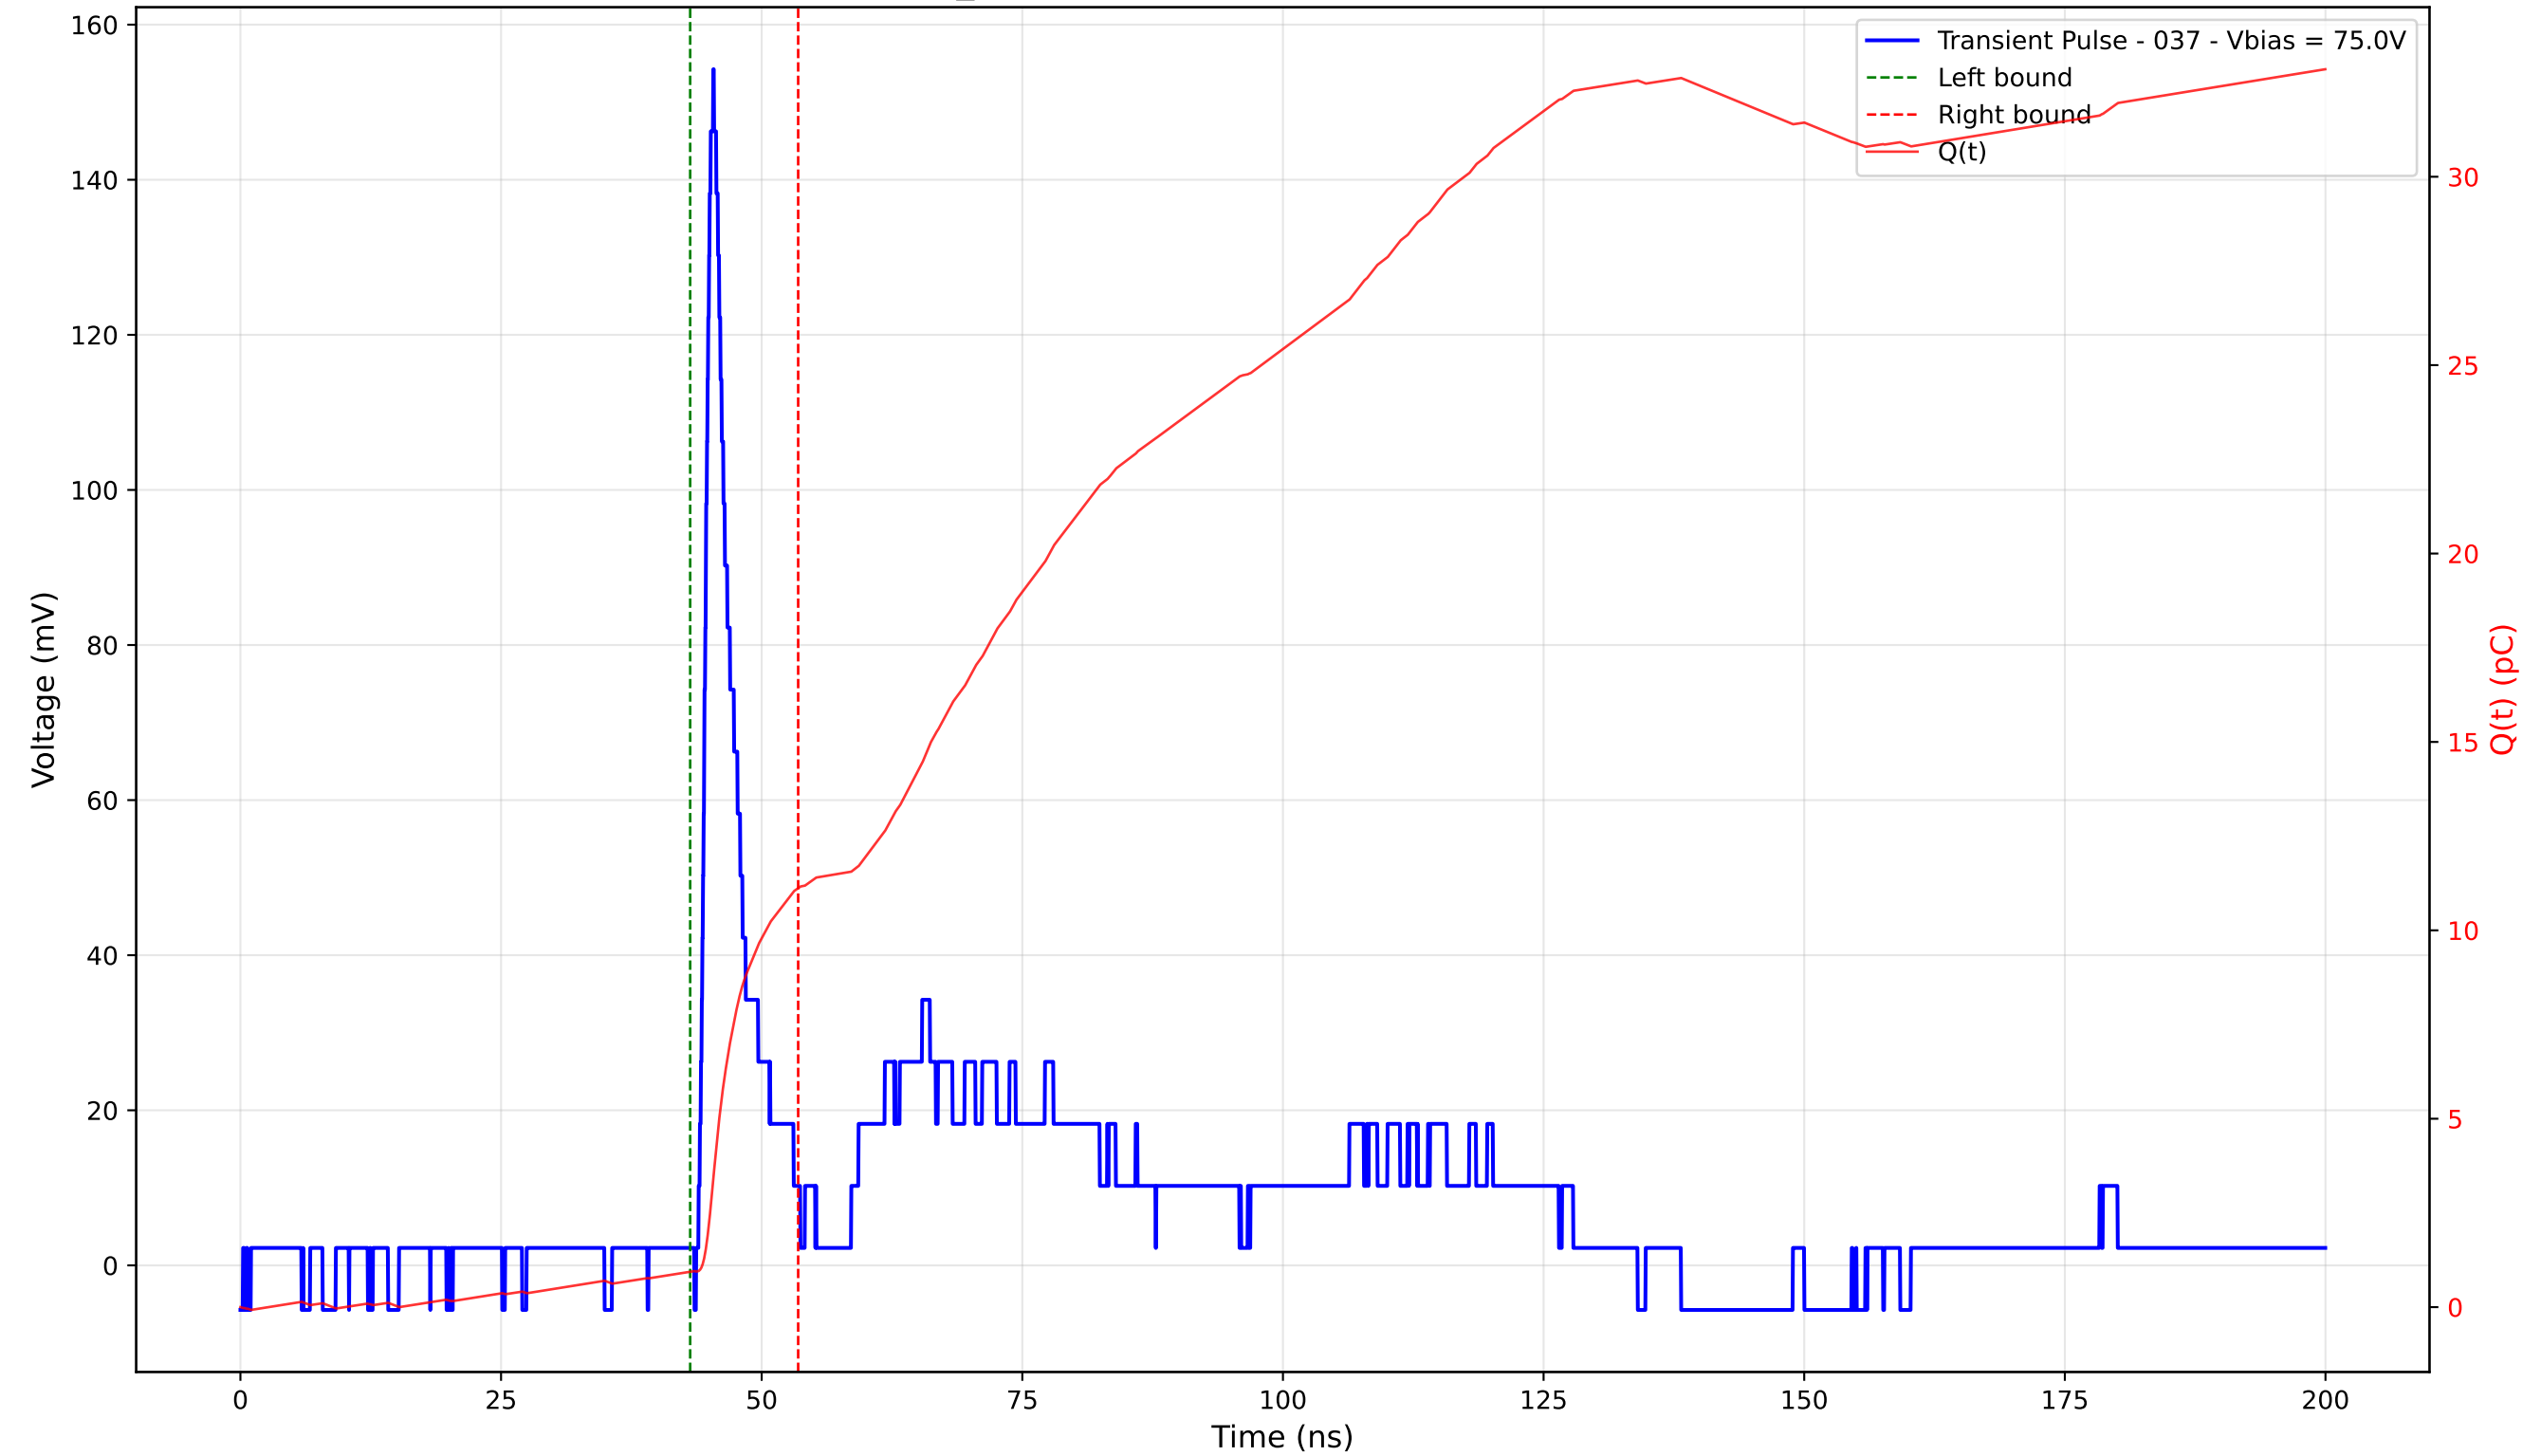


Transient Pulse - Sample: TD_4004 - Position: 65.0 μm - Charge: 15.94 pC - Rise Time: 0.98 ns

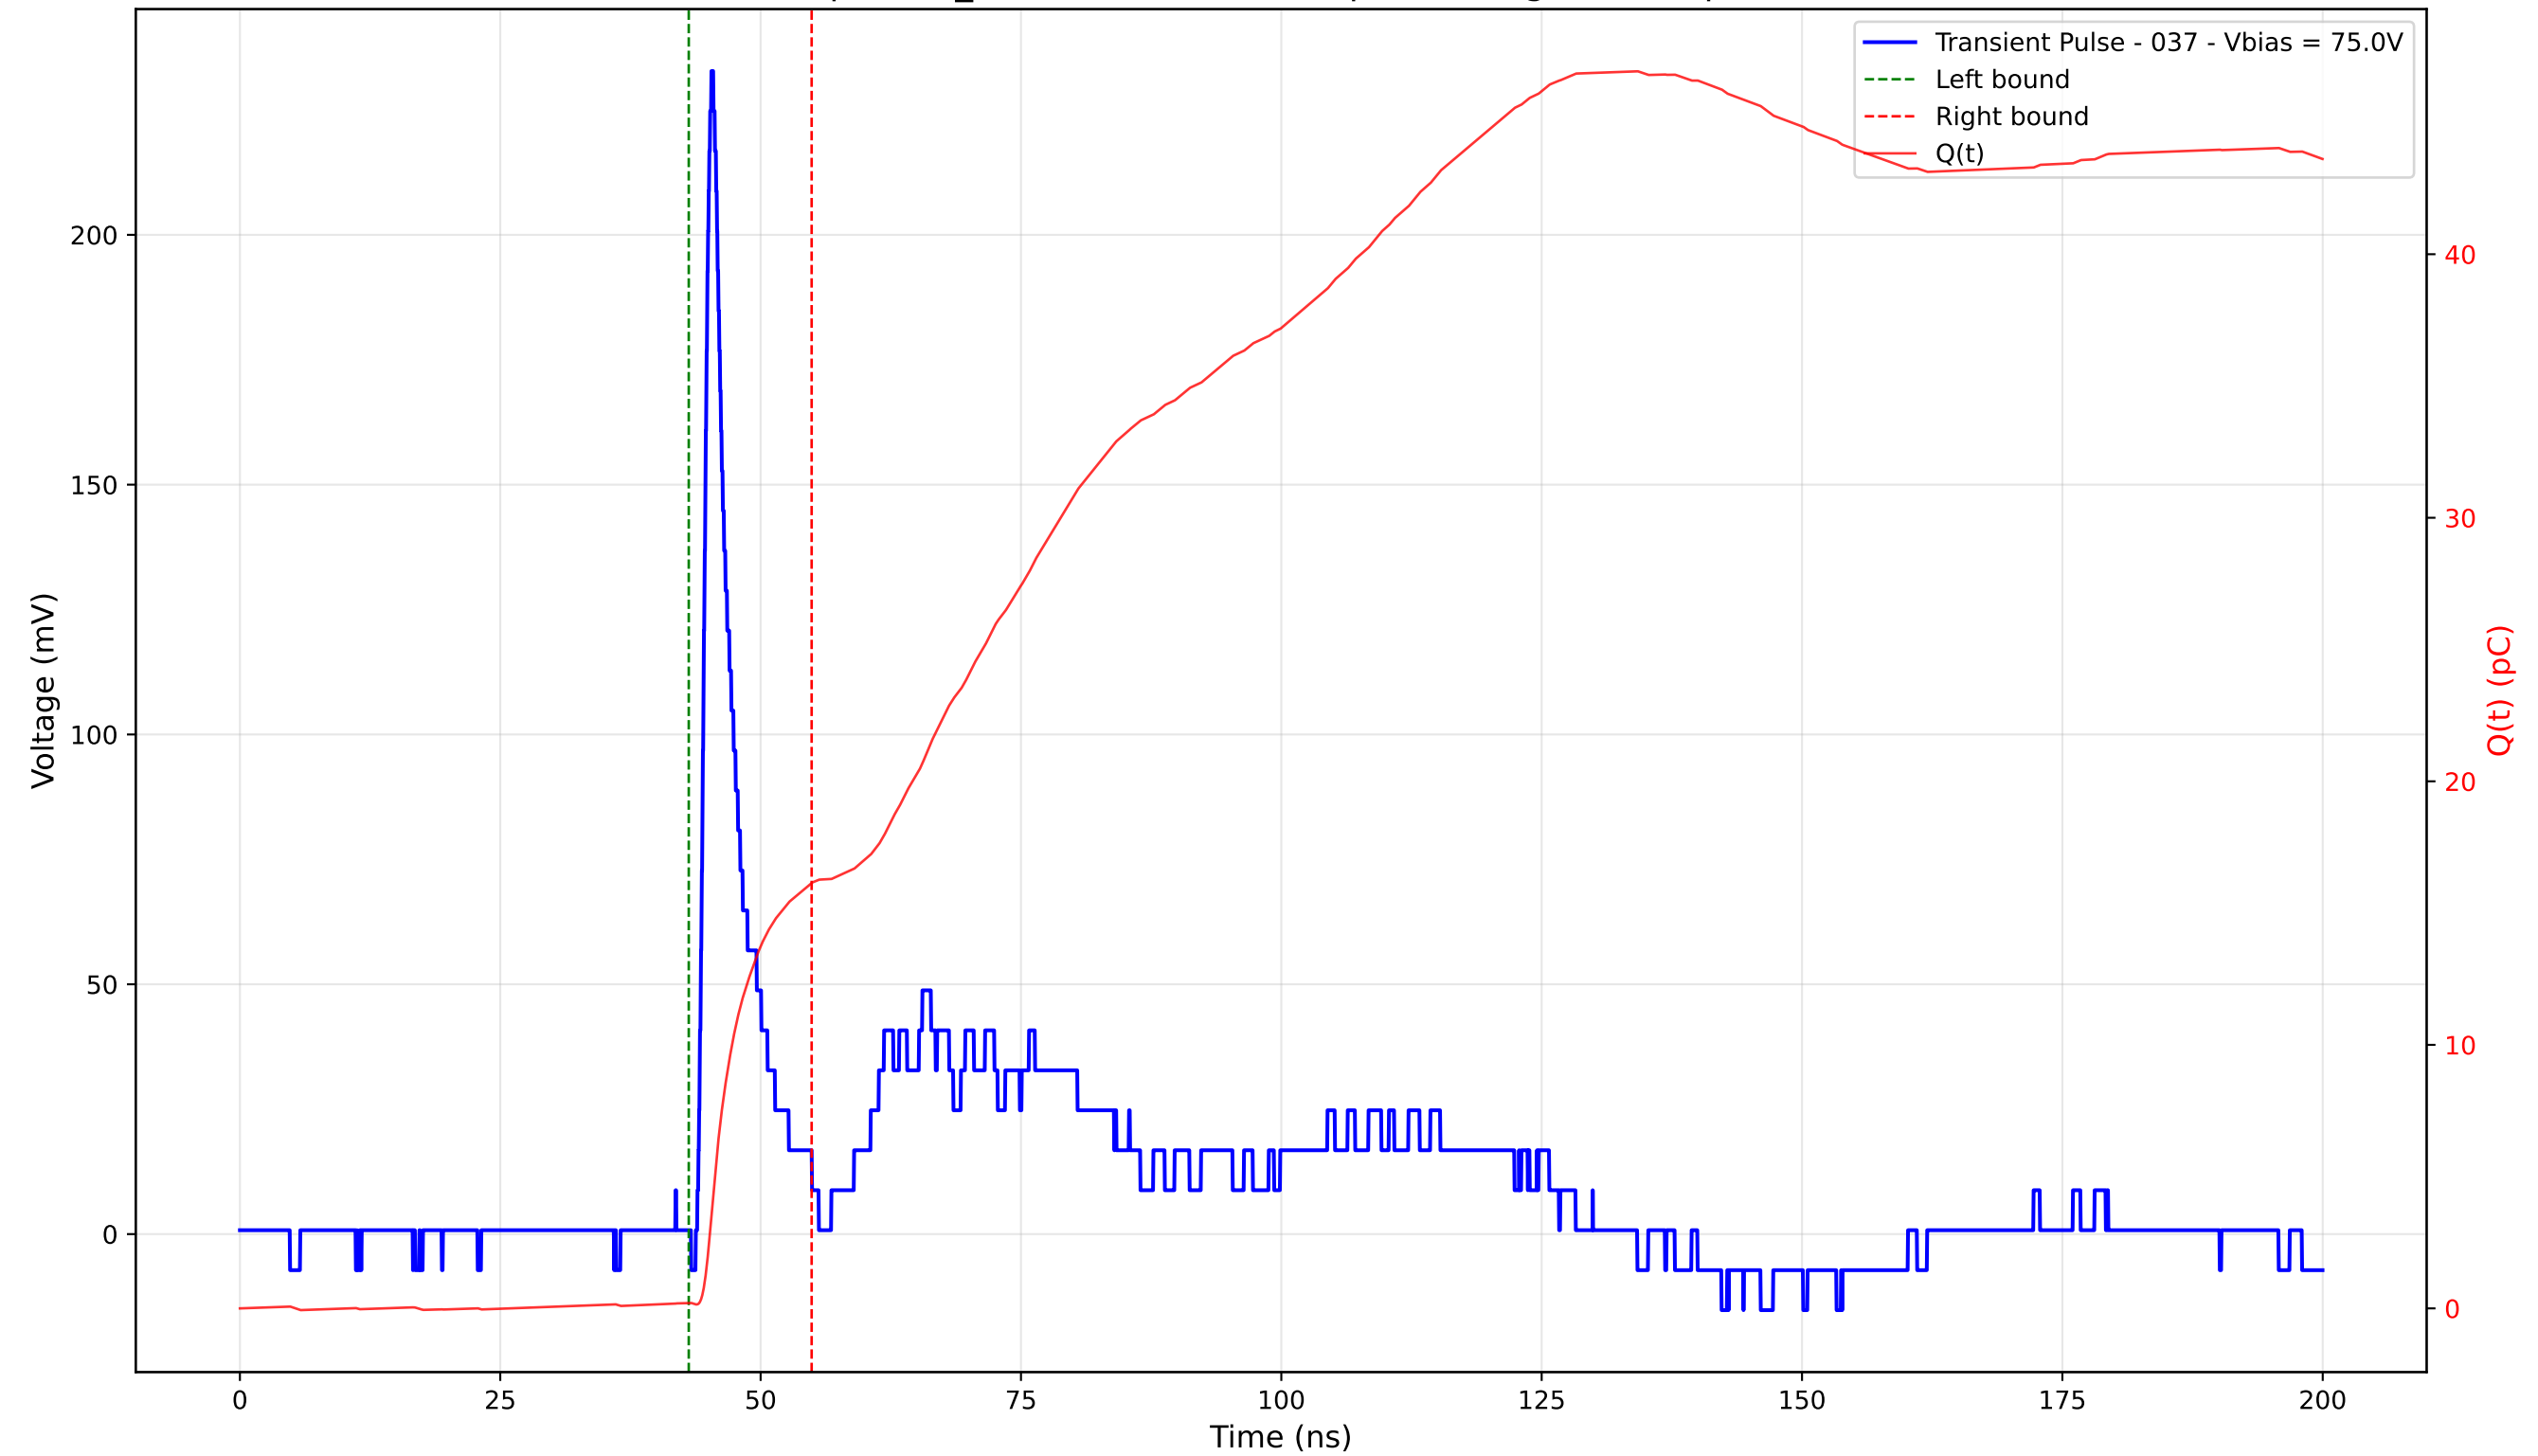


Transient Pulse - Sample: TD_4004 - Position: 70.0 μm - Charge: 22.82 pC - Rise Time: 0.92 ns

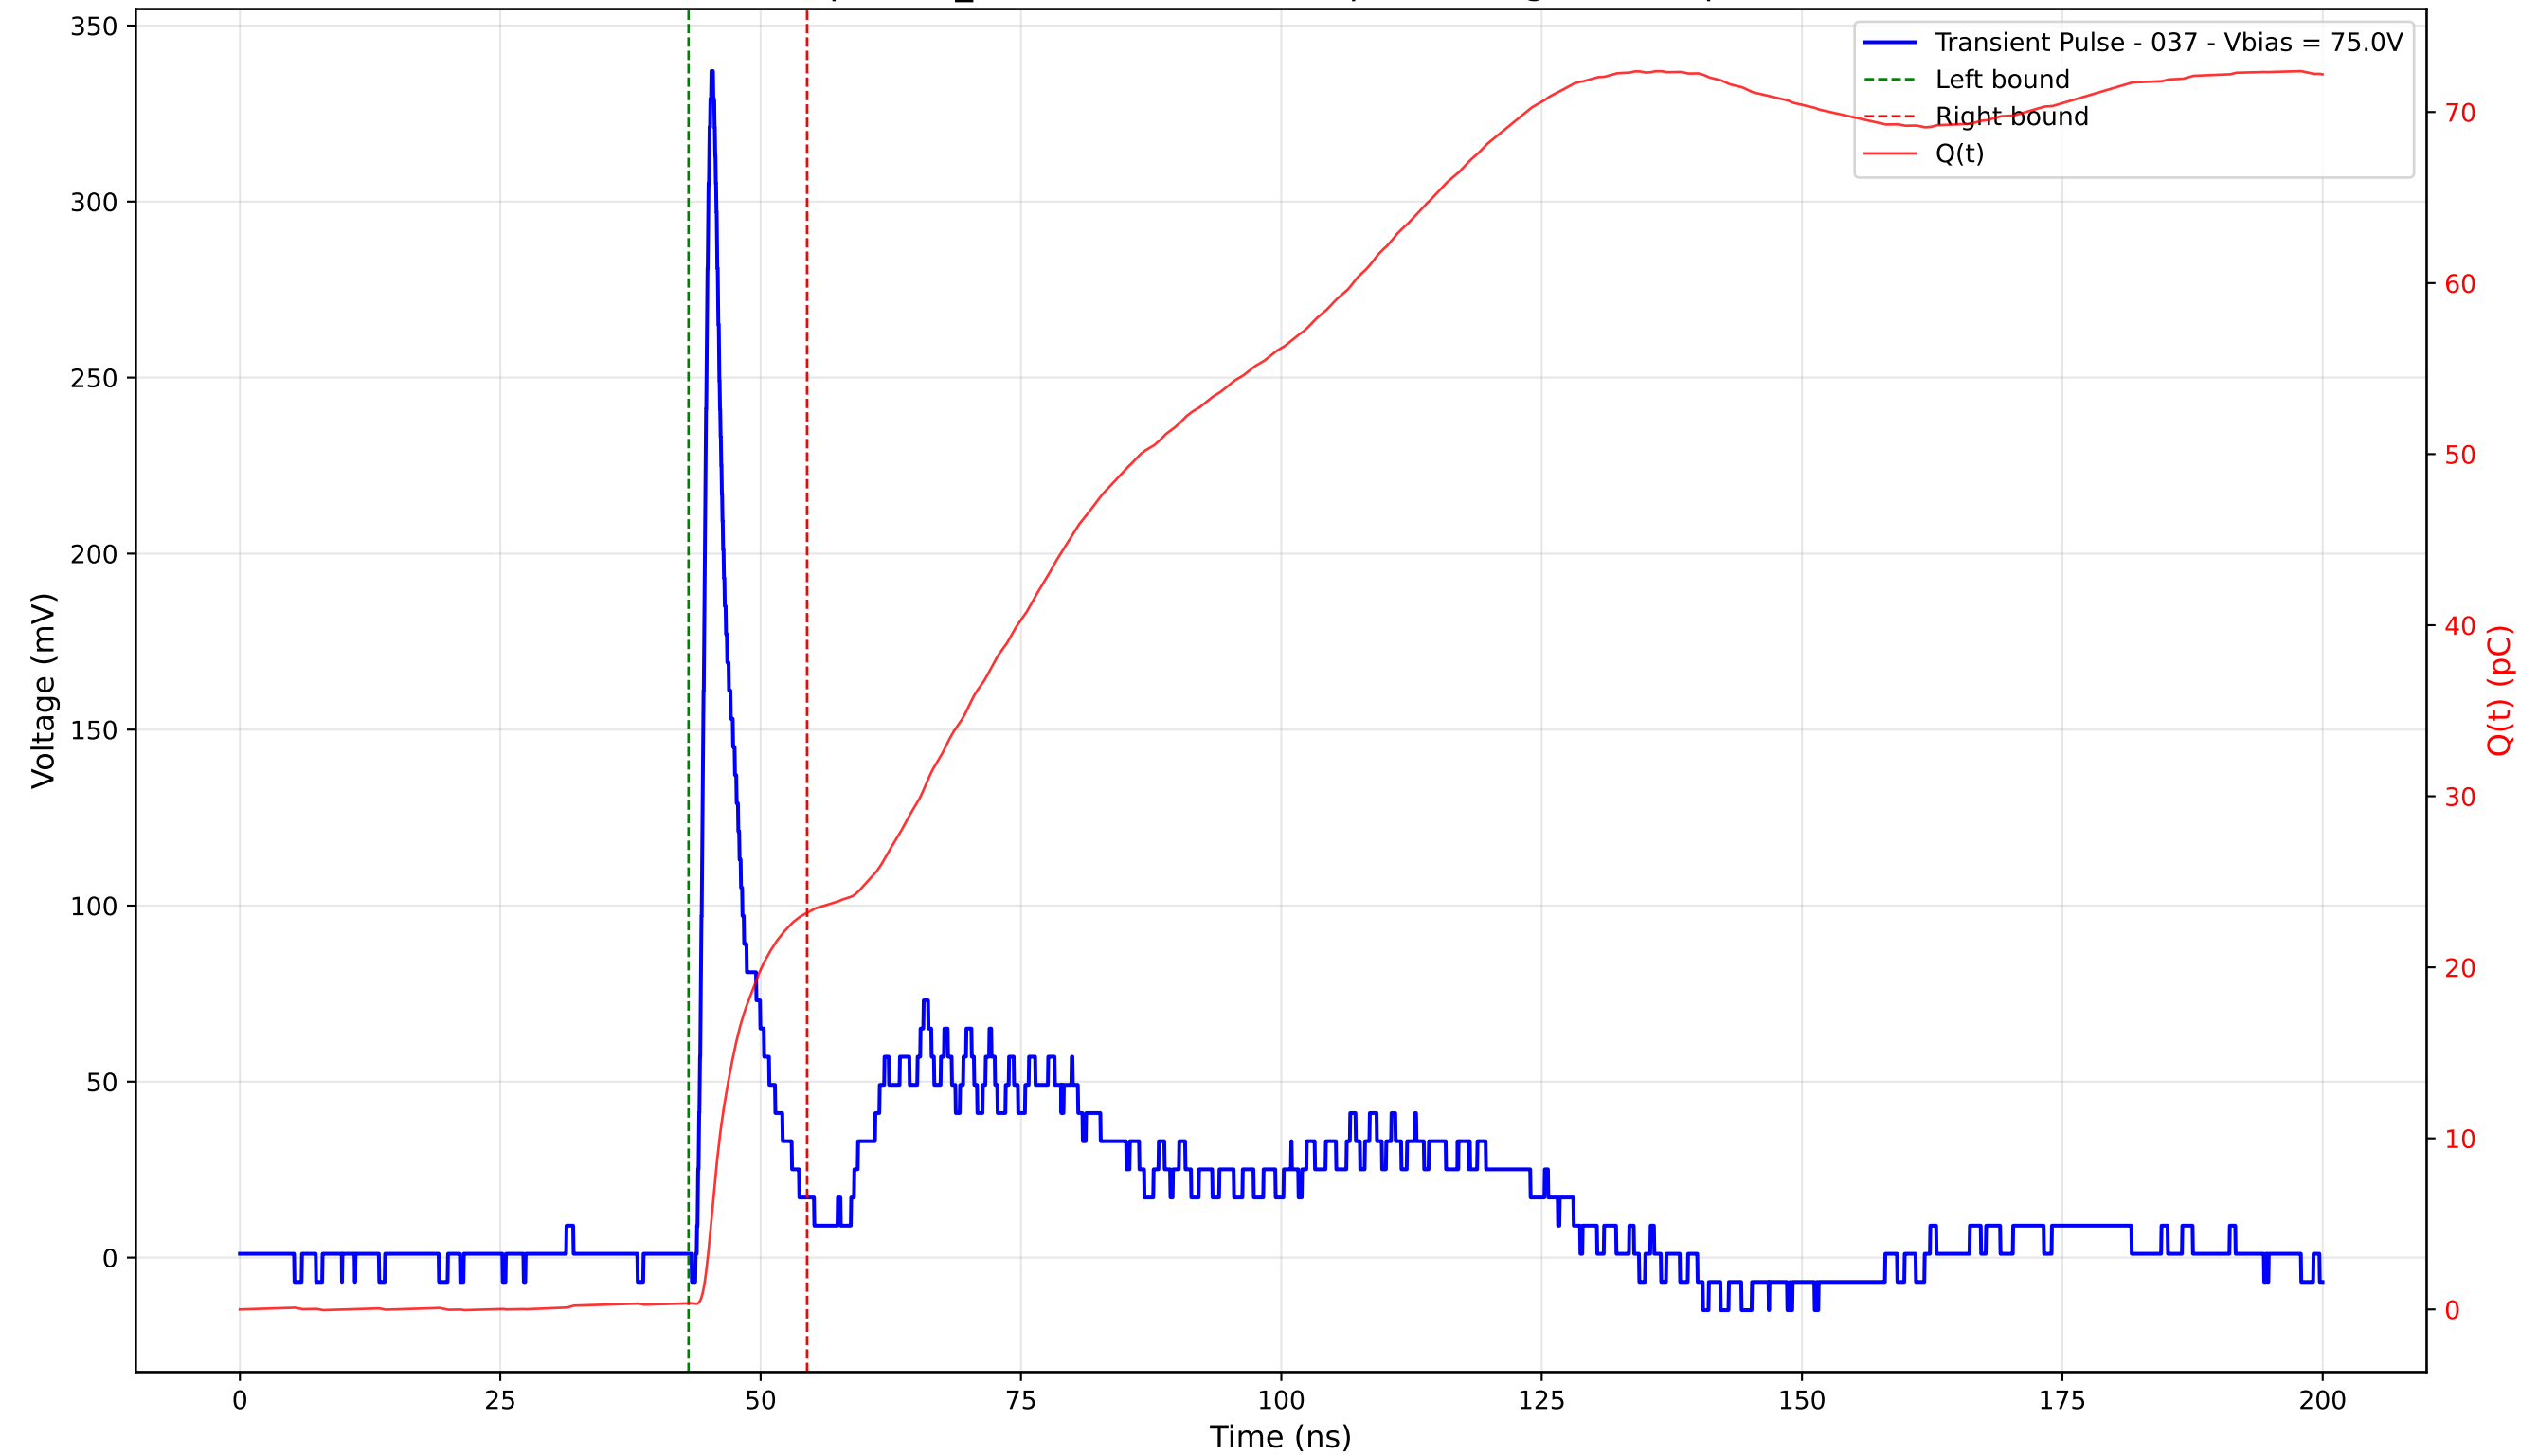


Transient Pulse - Sample: TD_4004 - Position: 75.0 μm - Charge: 28.55 pC - Rise Time: 0.90 ns

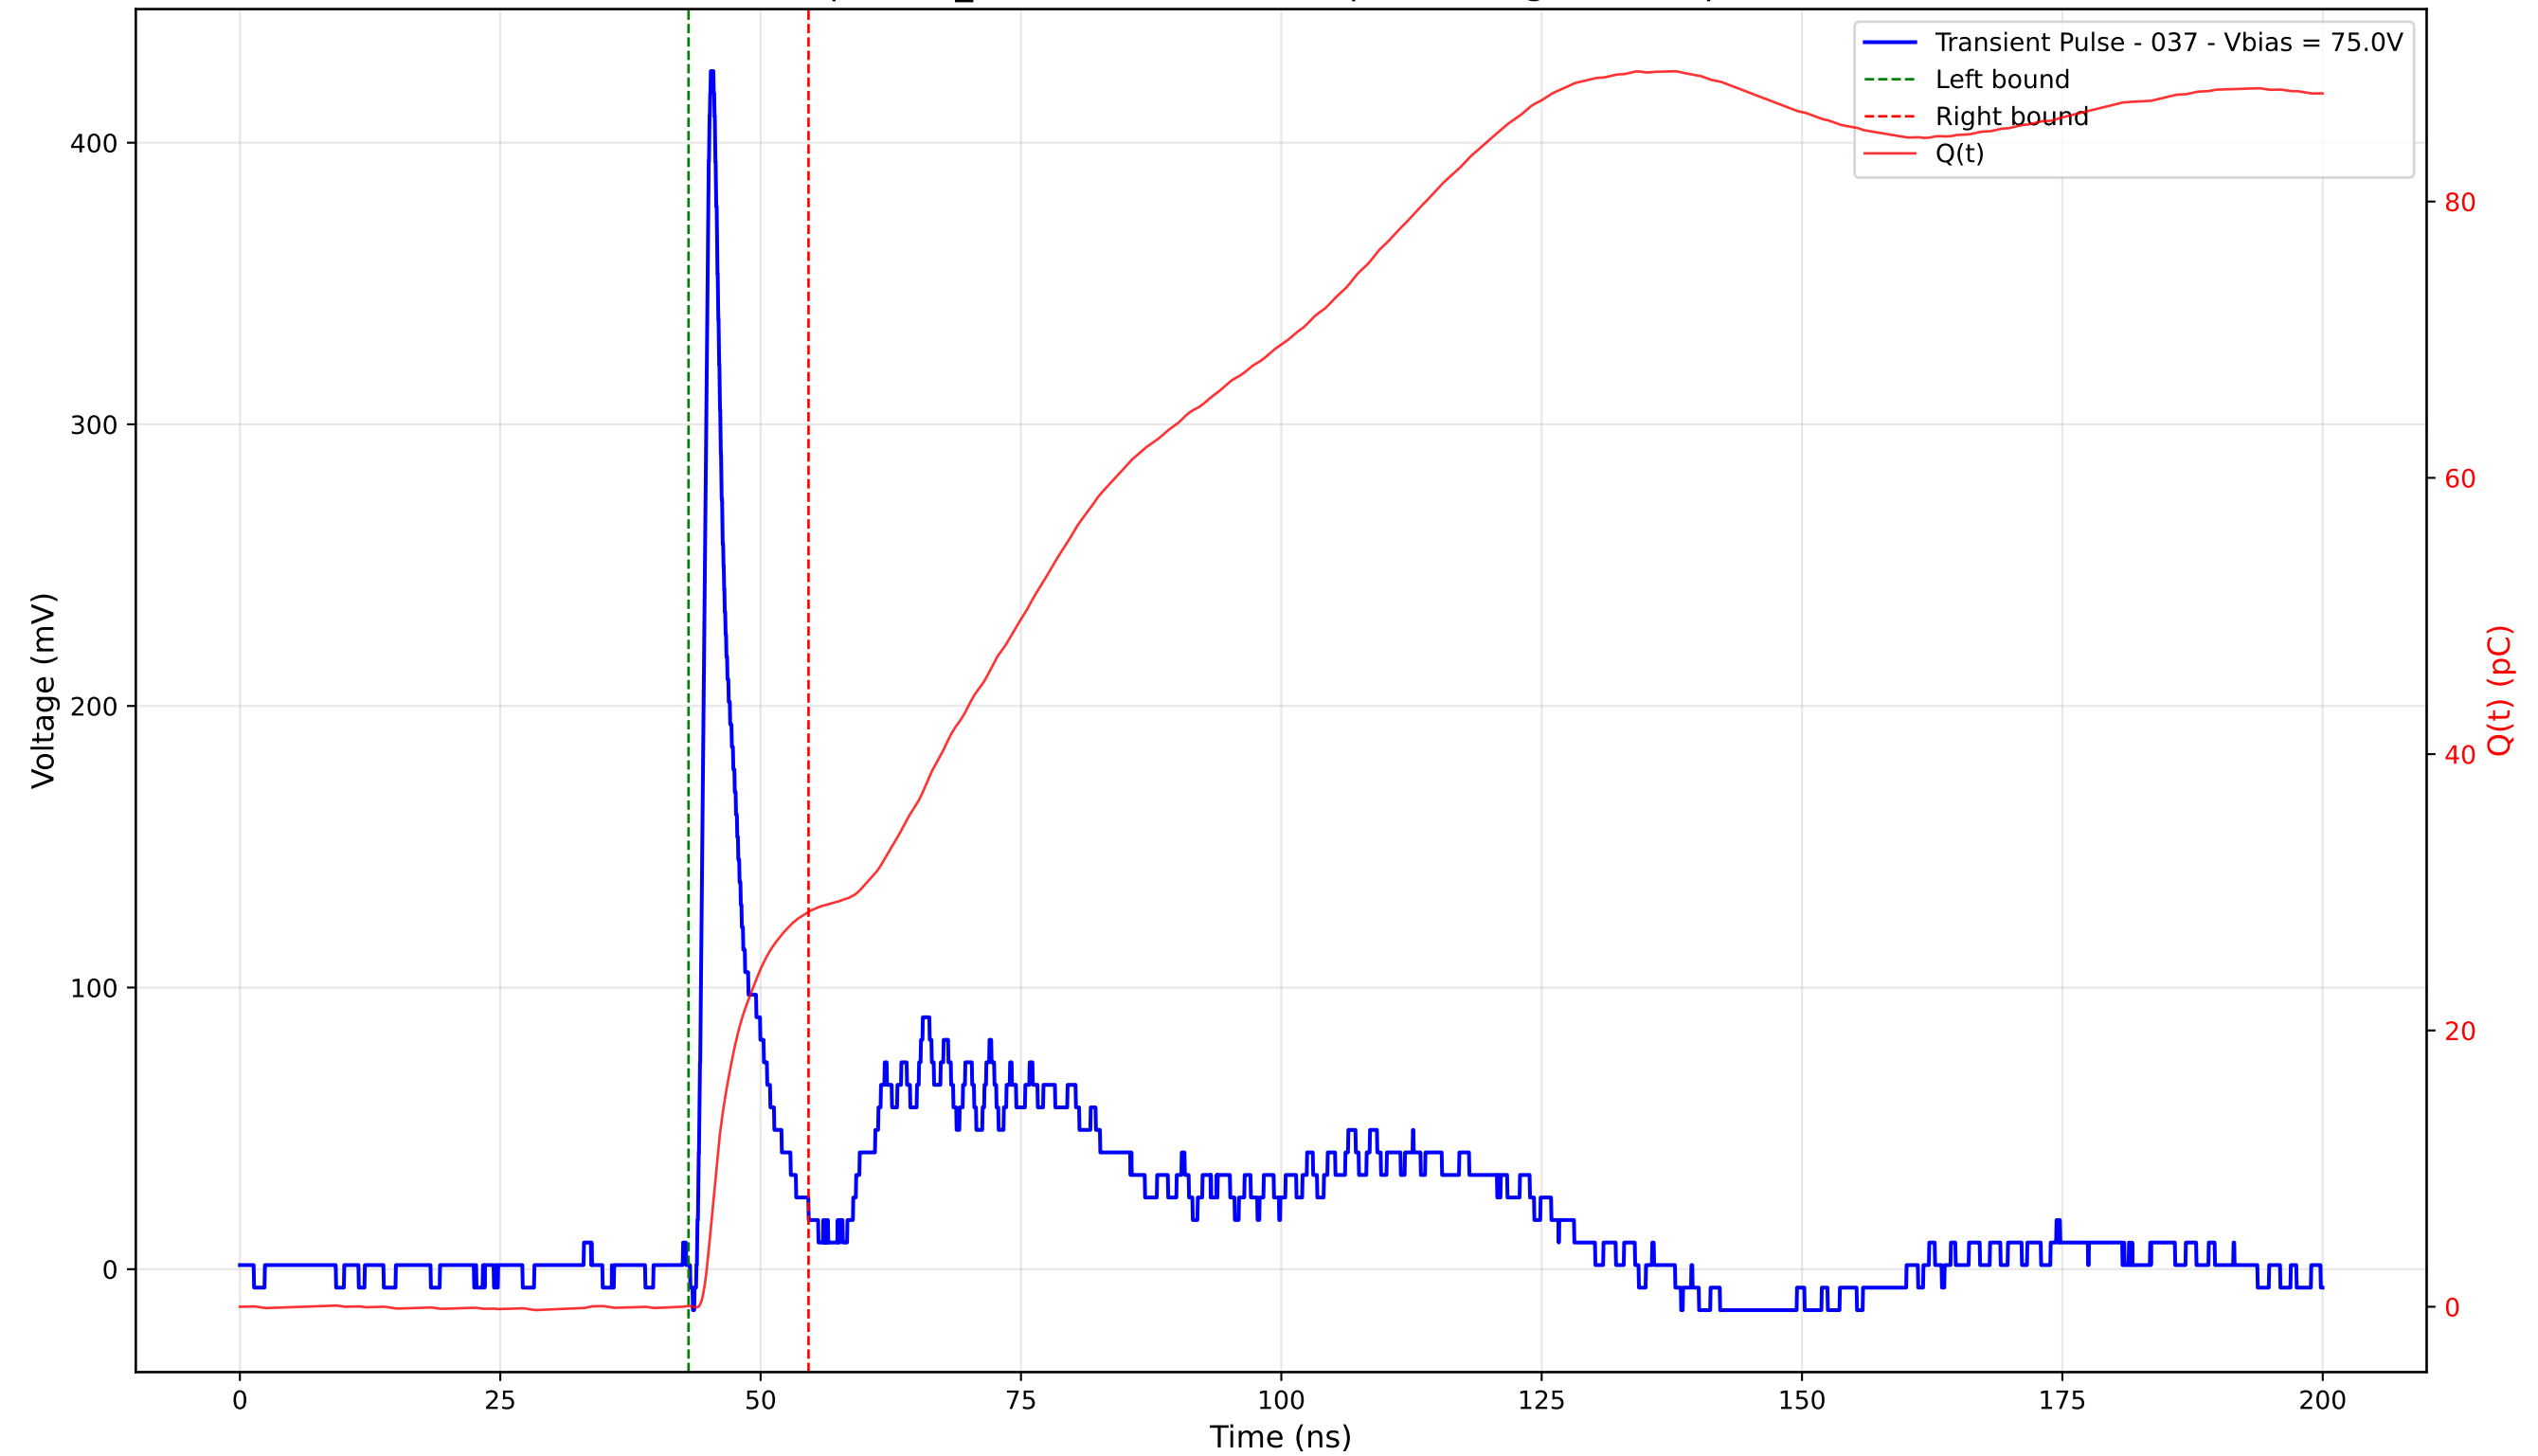


Transient Pulse - Sample: TD_4004 - Position: 80.0 μm - Charge: 34.60 pC - Rise Time: 0.92 ns

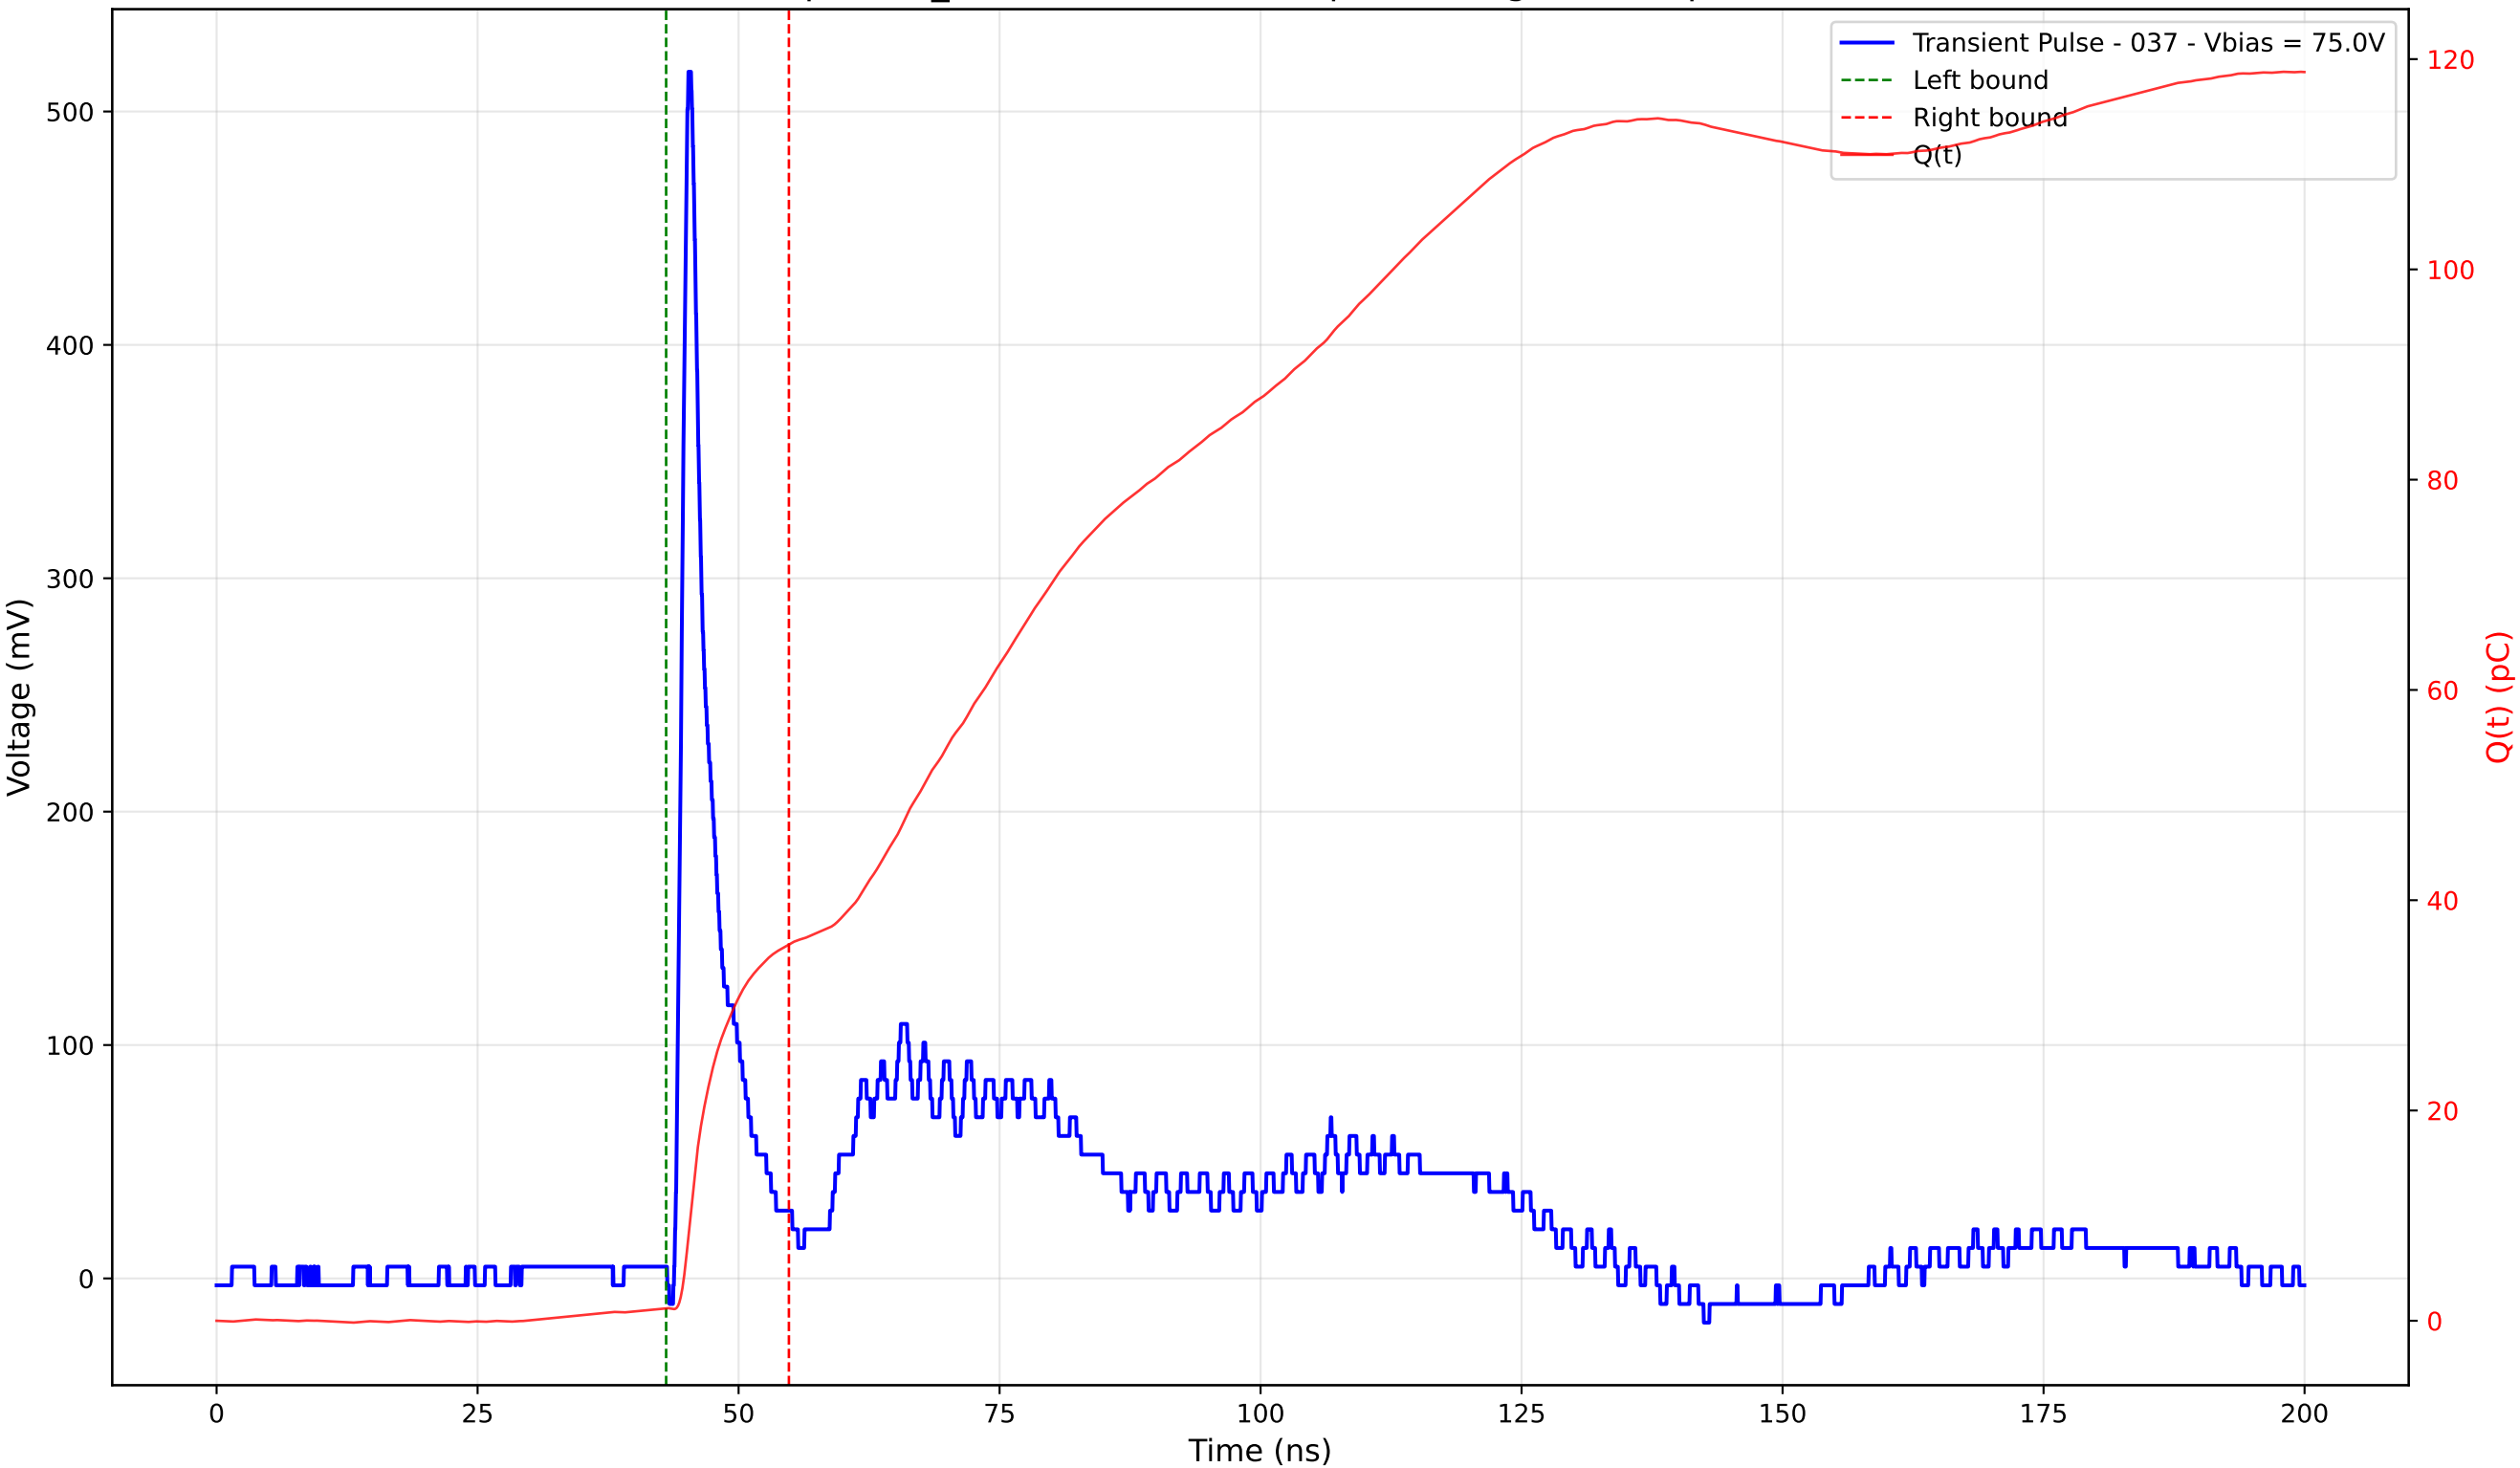


Transient Pulse - Sample: TD_4004 - Position: 85.0 μm - Charge: 37.58 pC - Rise Time: 0.94 ns

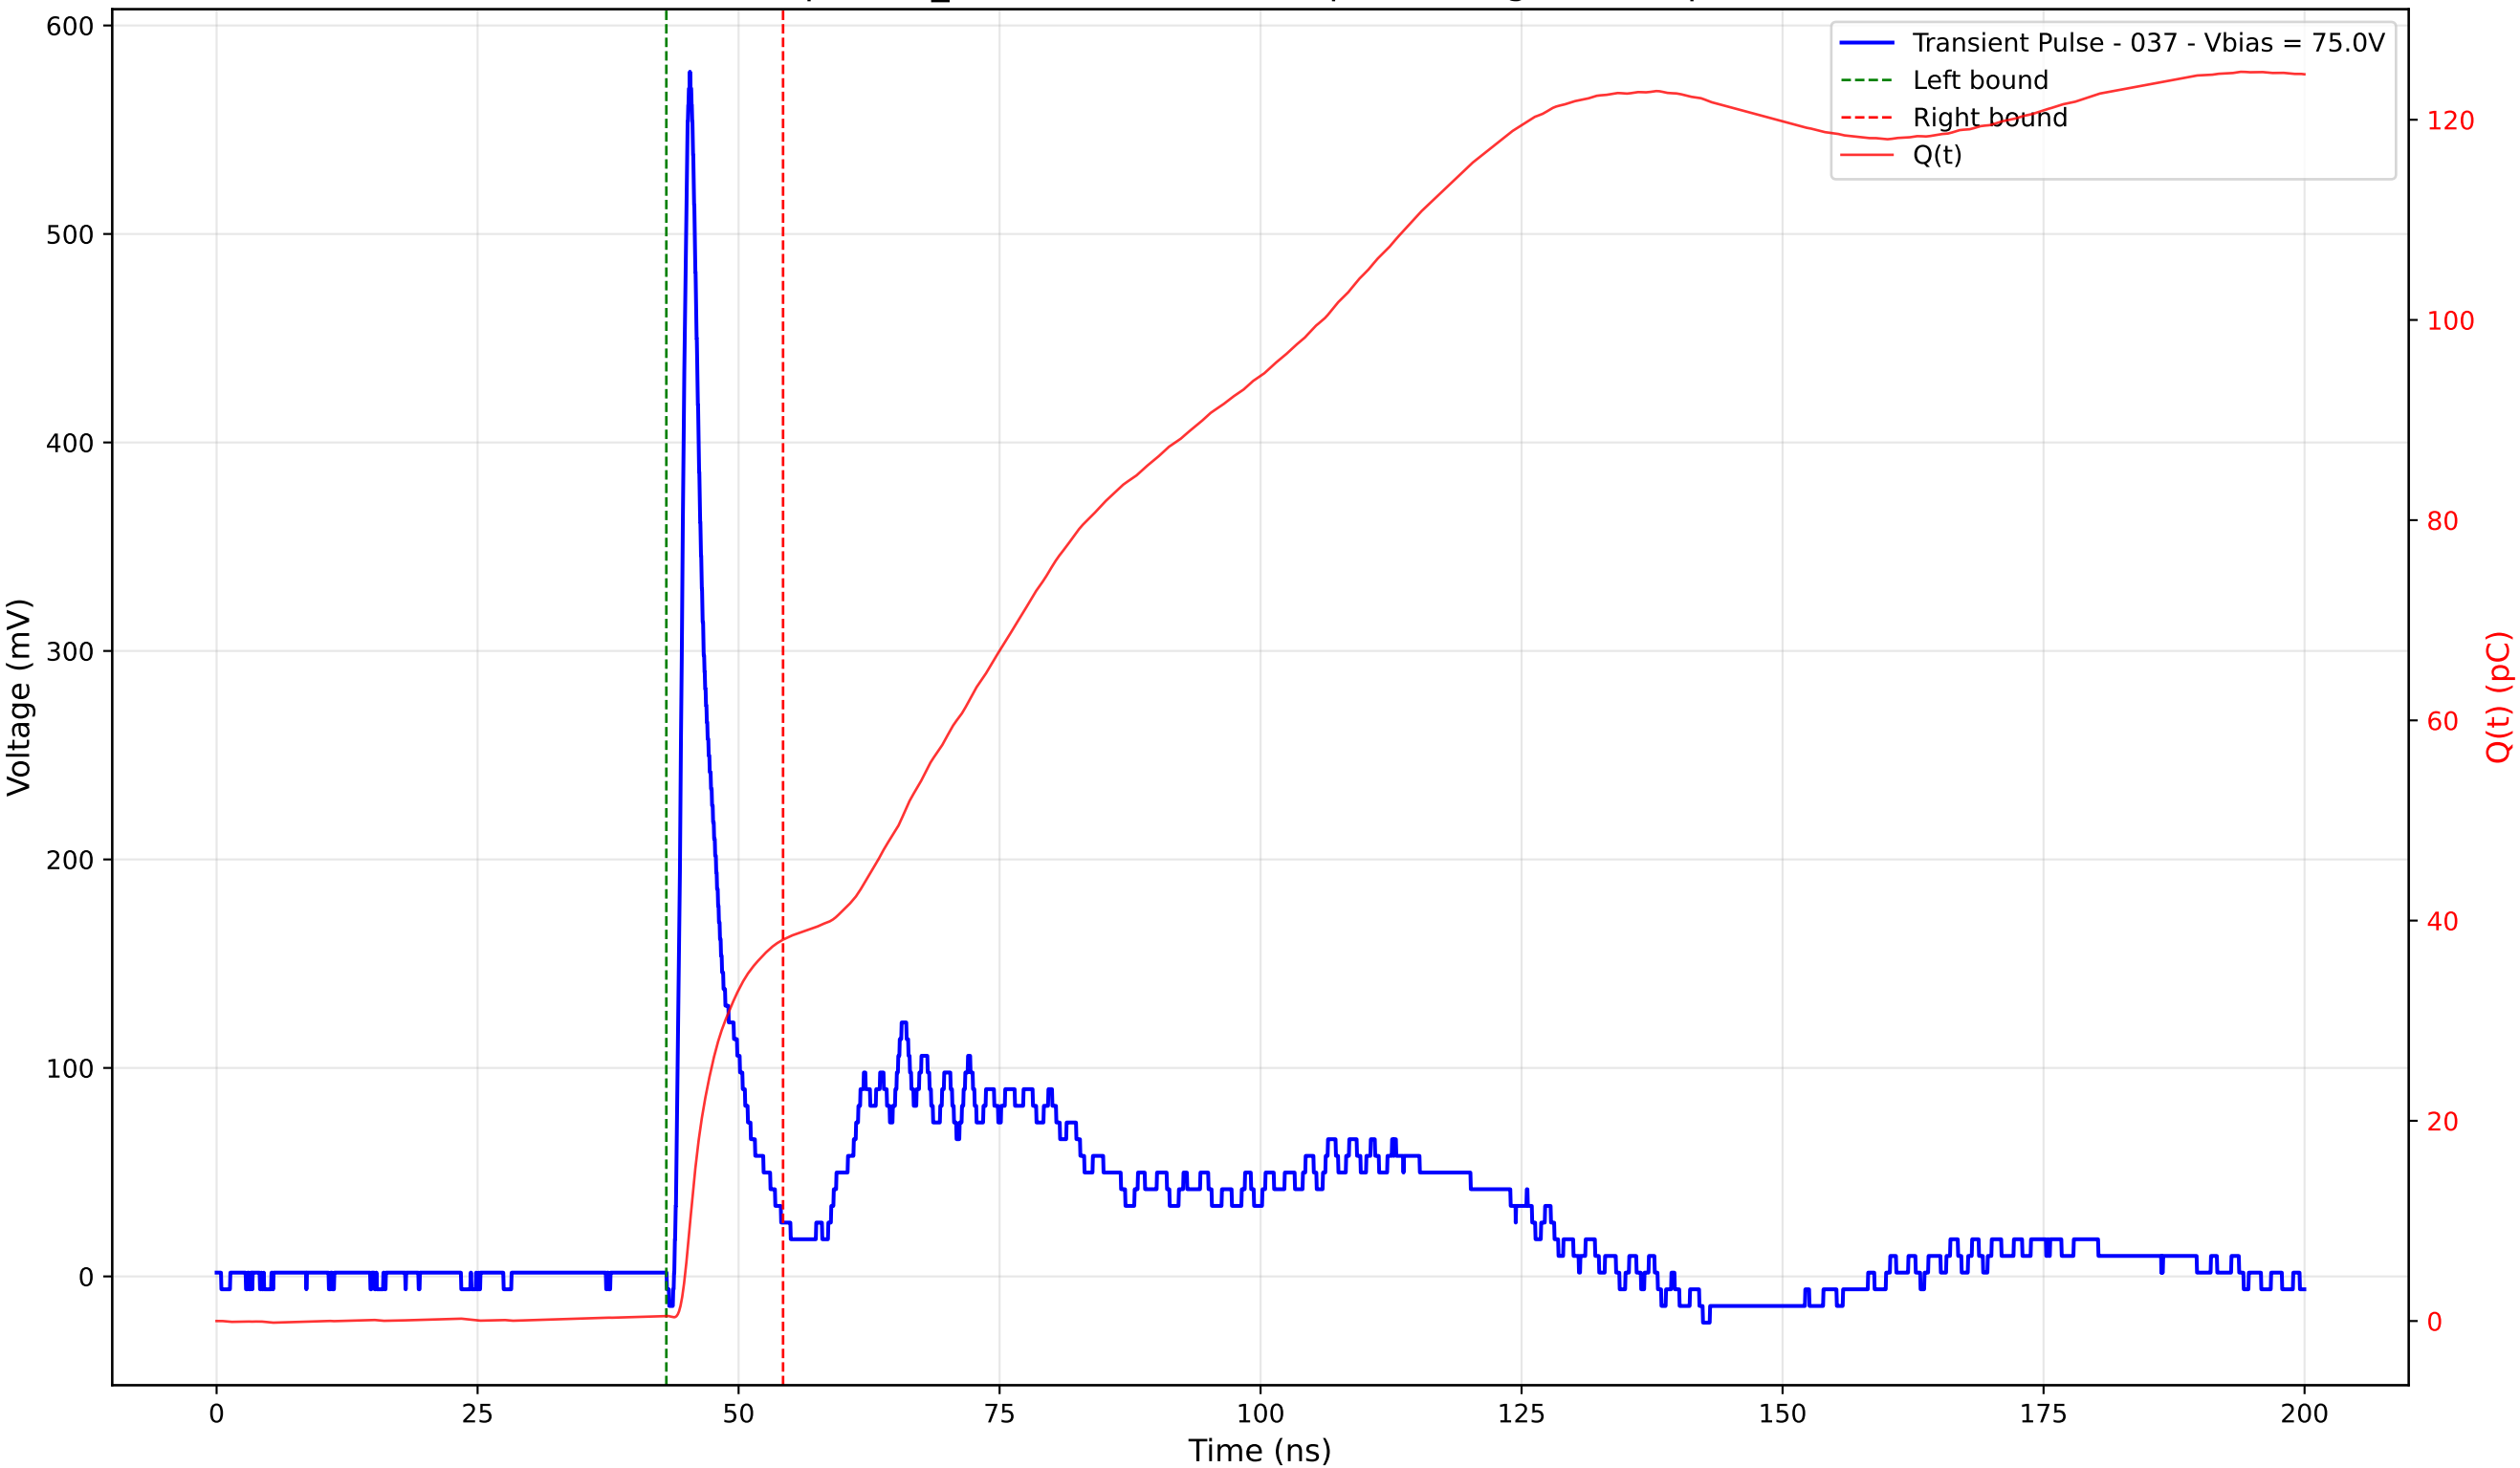


Transient Pulse - Sample: TD_4004 - Position: 90.0 μm - Charge: 41.76 pC - Rise Time: 0.96 ns

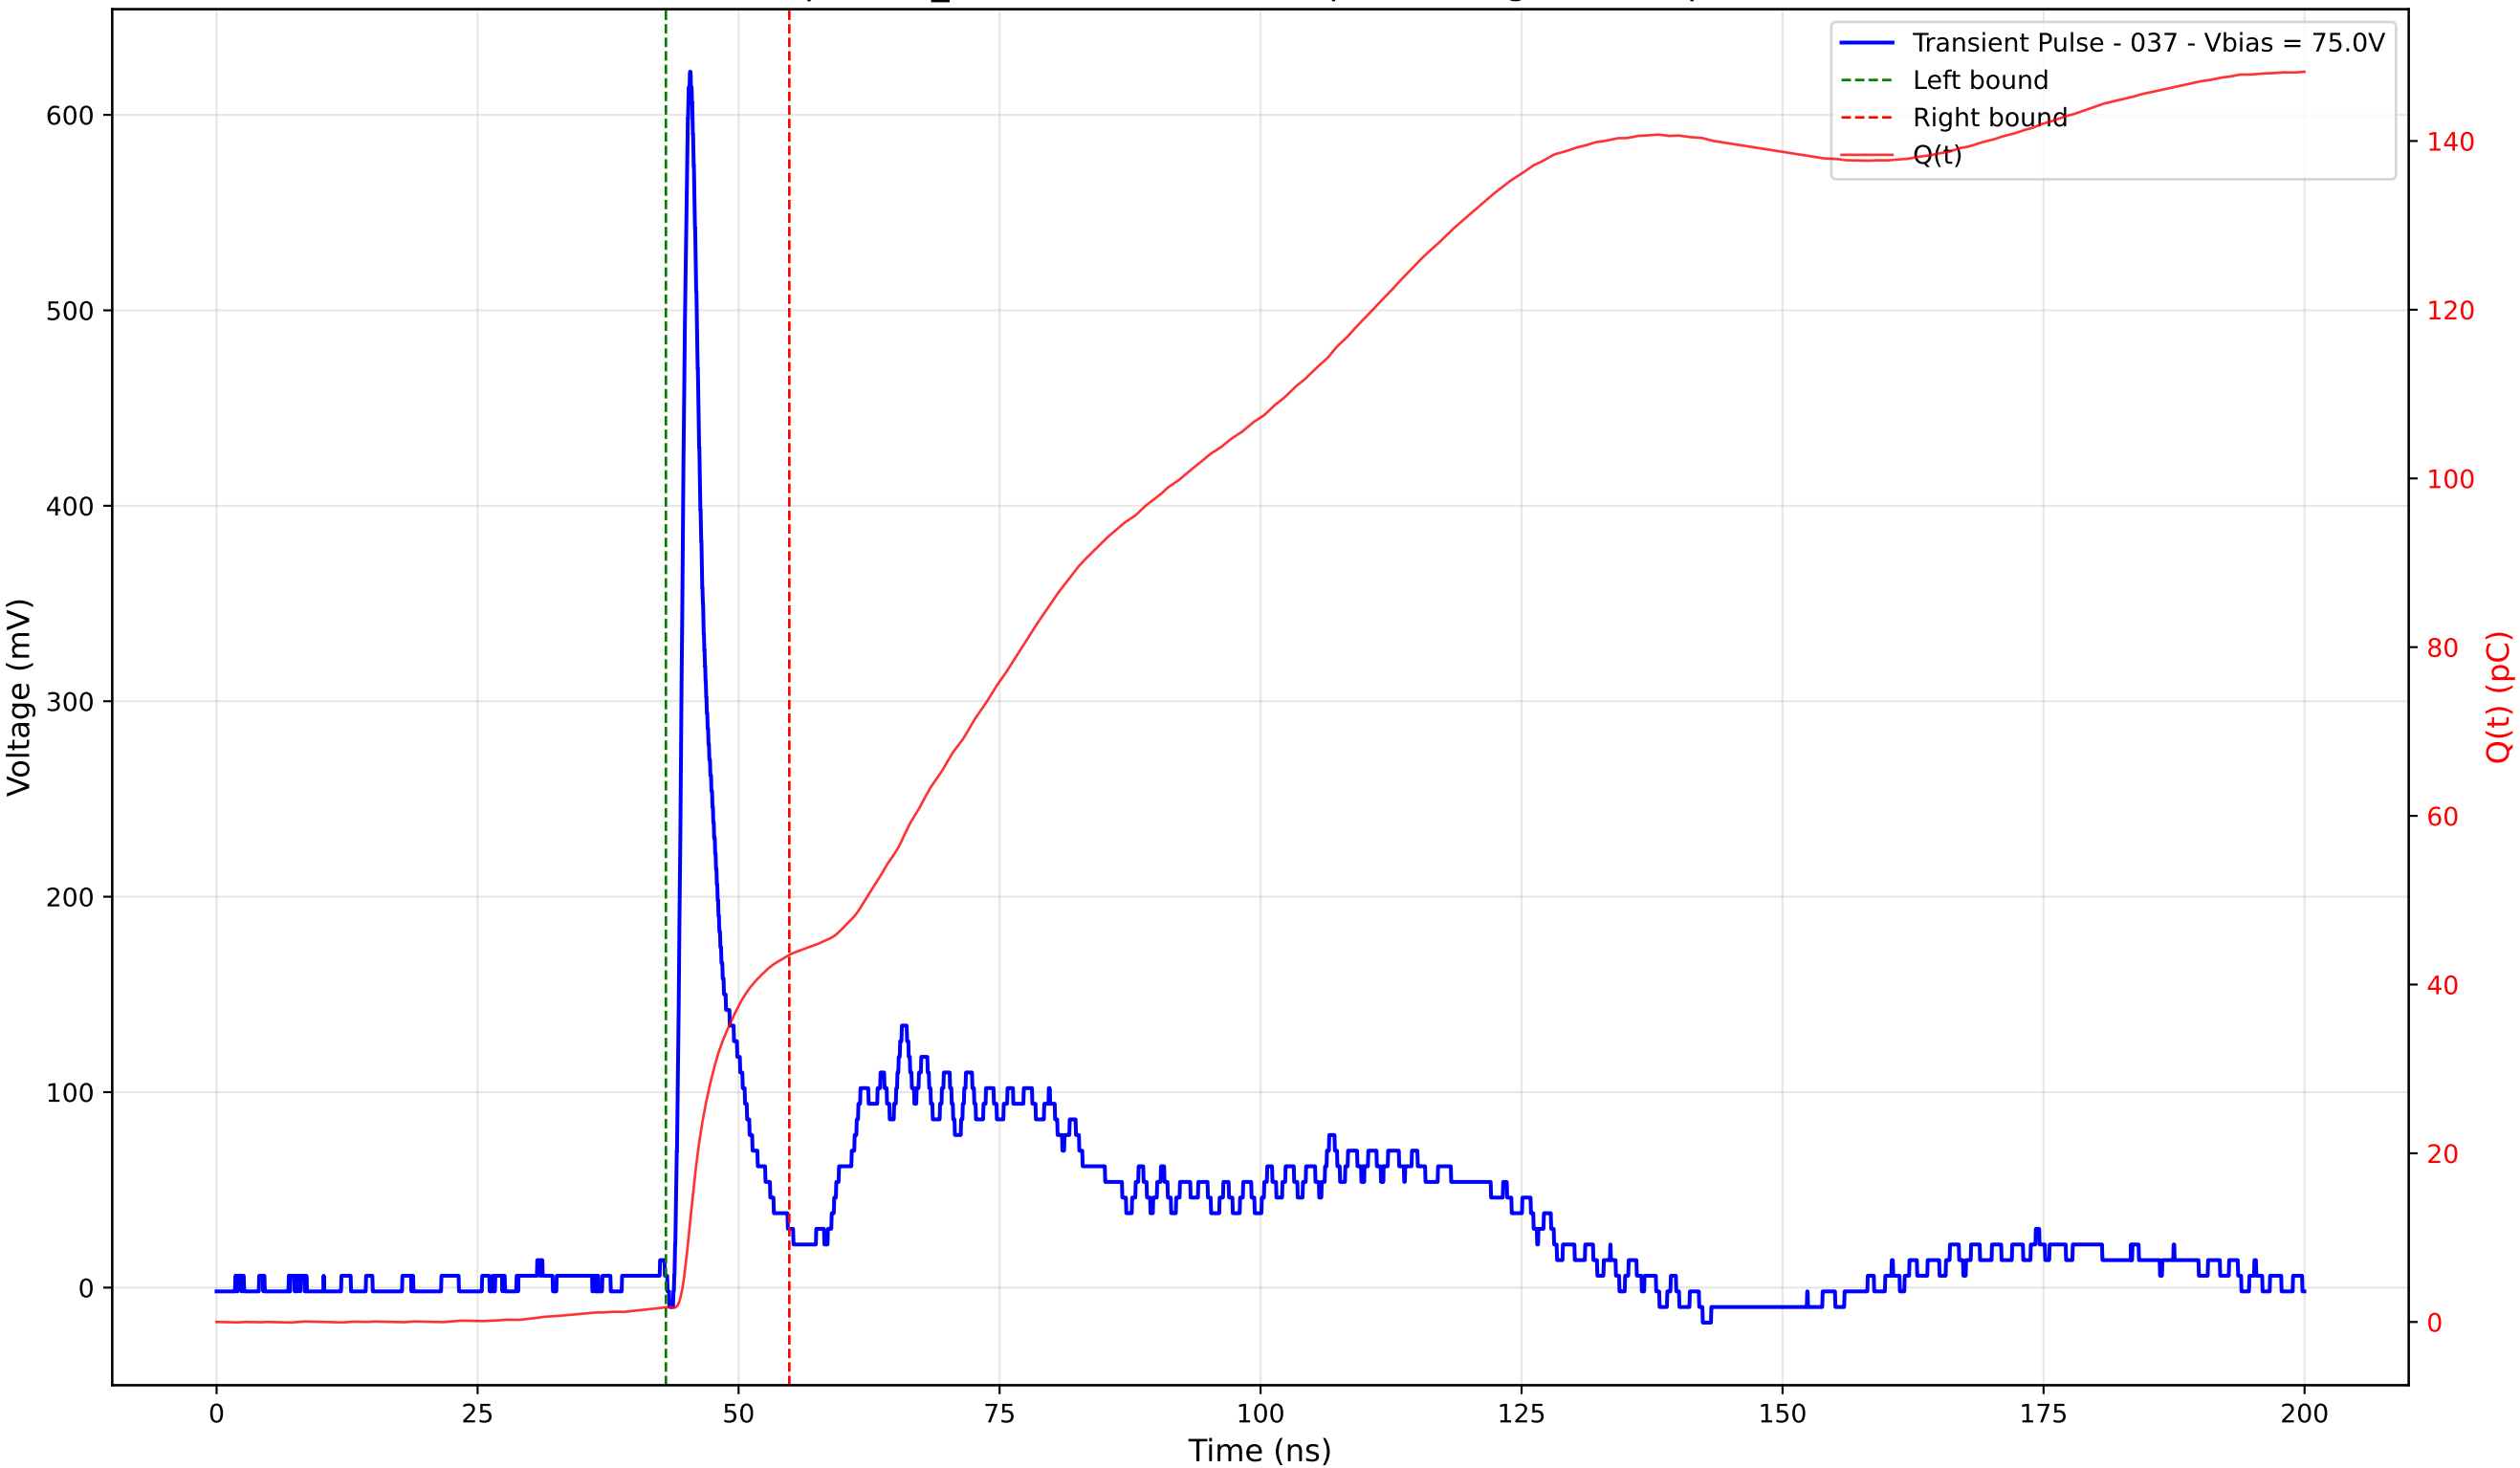


Transient Pulse - Sample: TD_4004 - Position: 95.0 μm - Charge: 44.06 pC - Rise Time: 0.94 ns

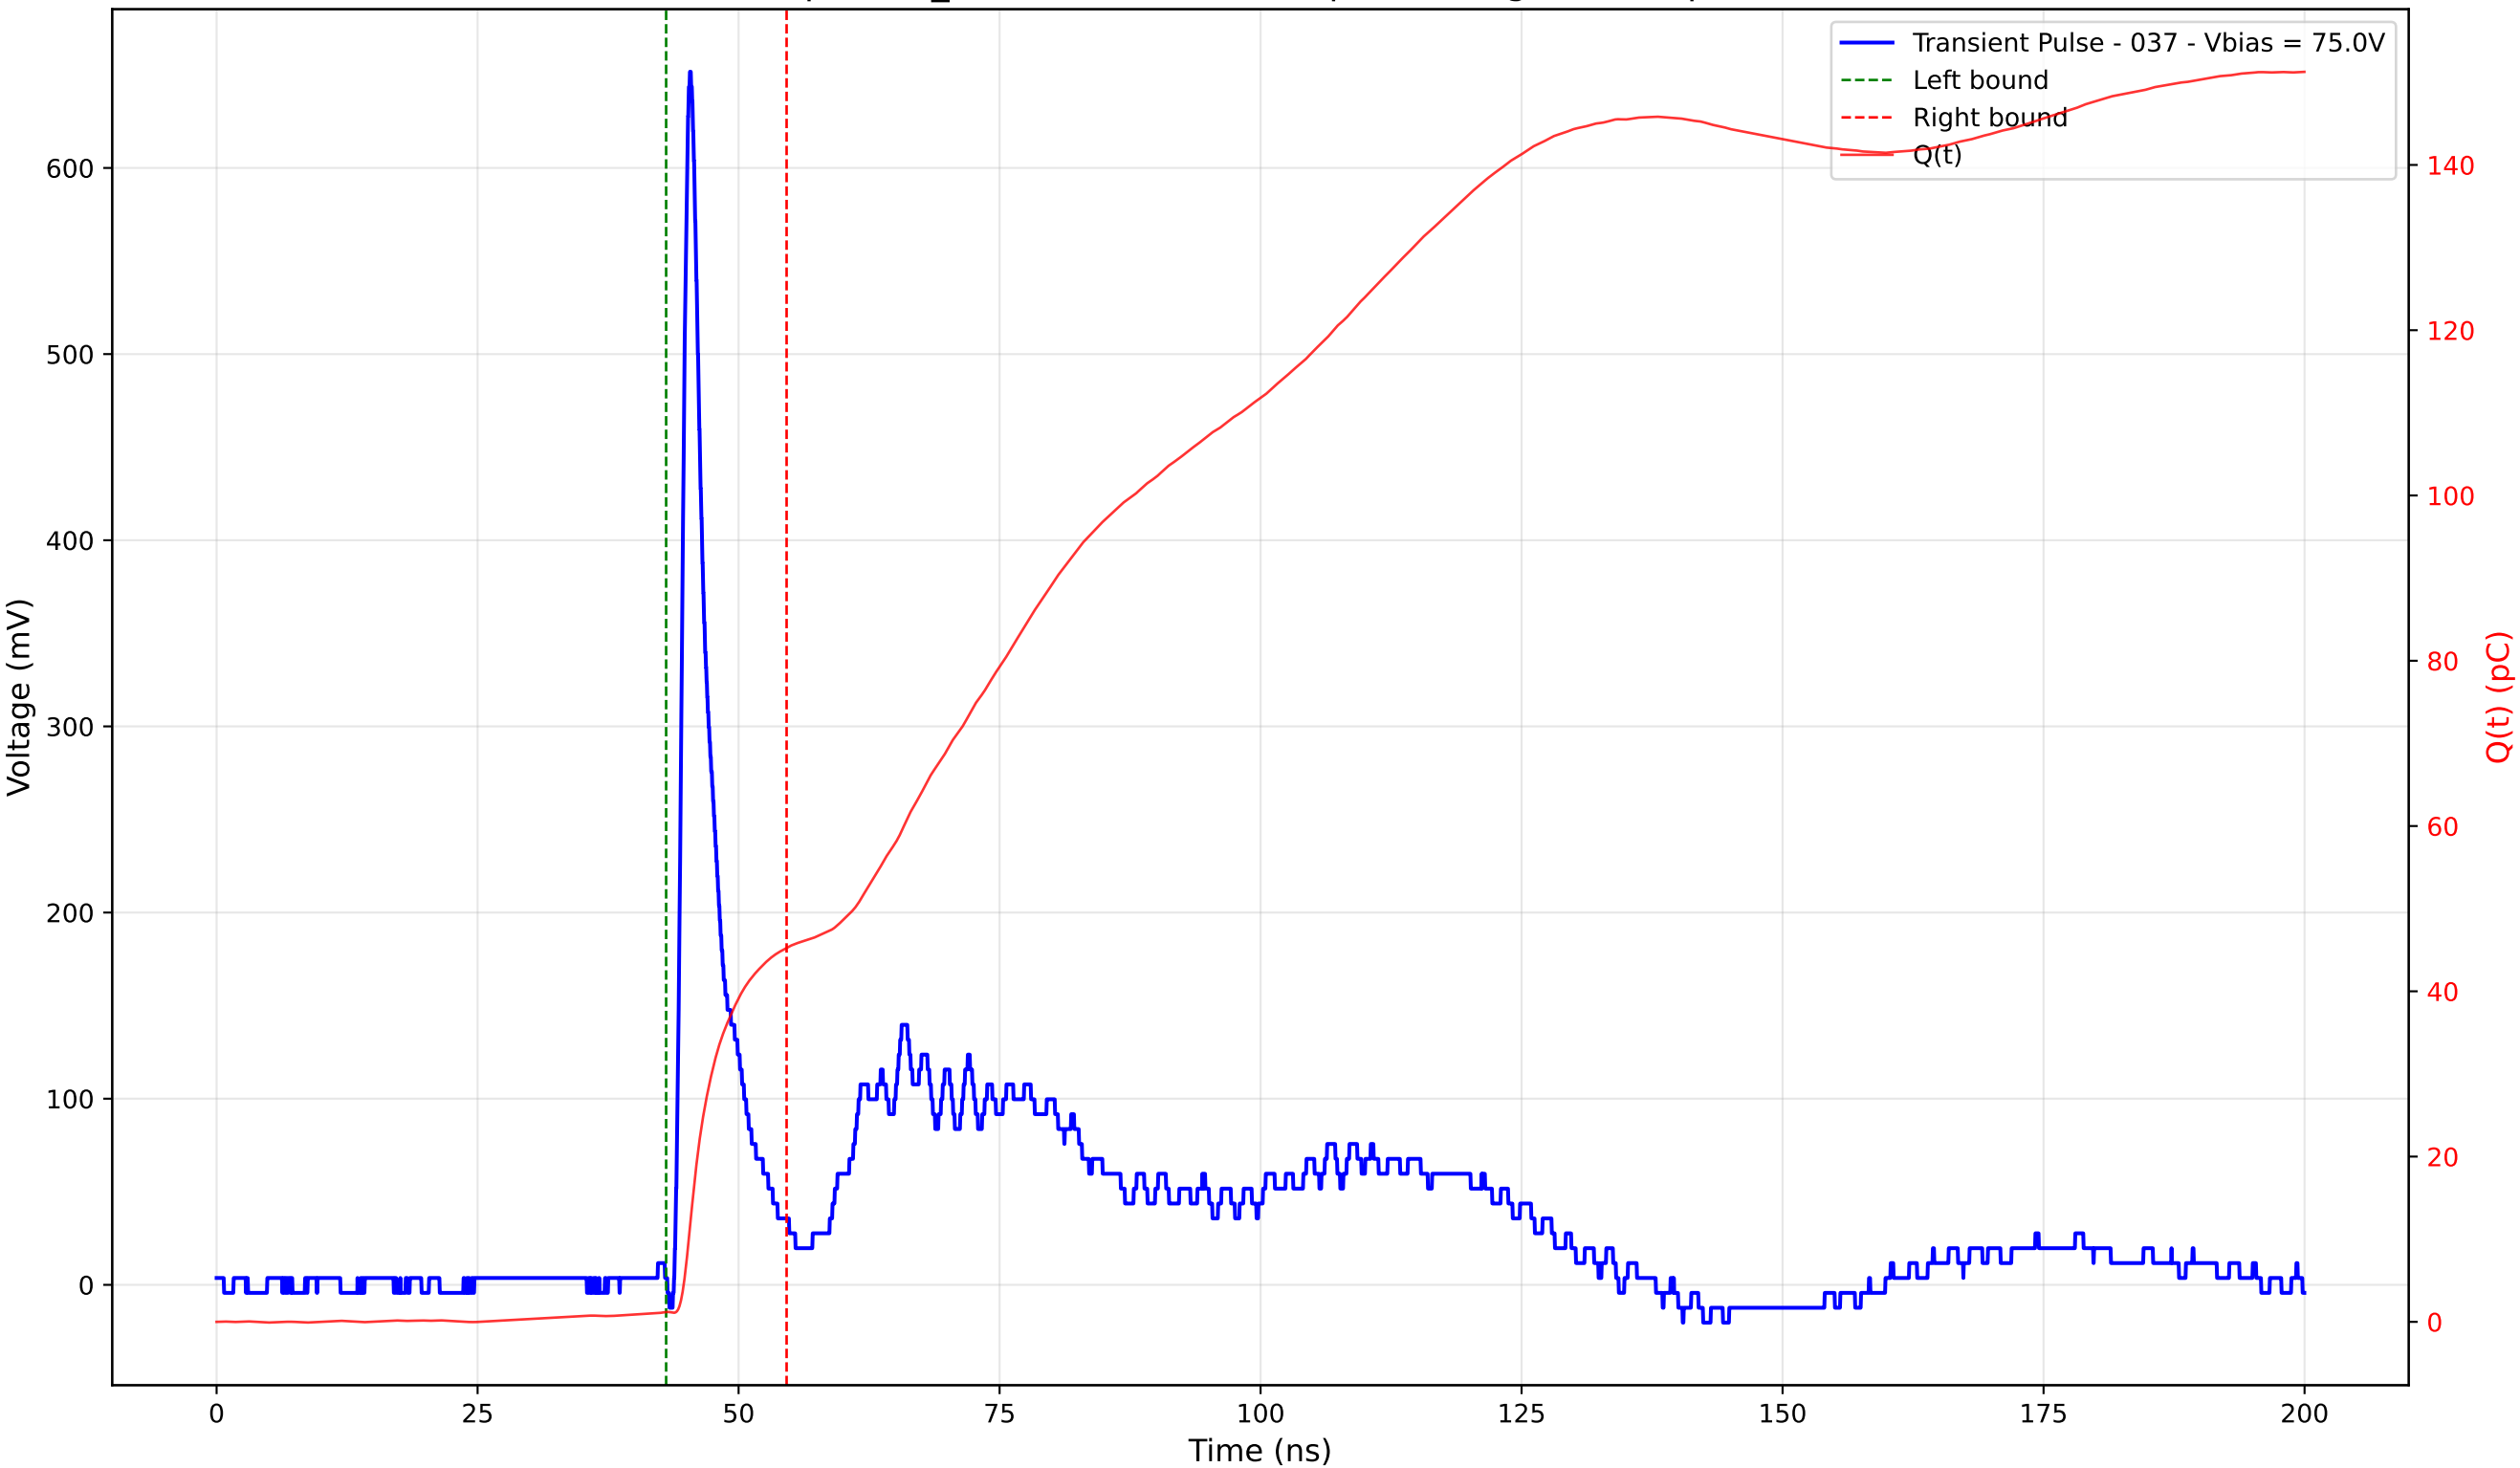


Transient Pulse - Sample: TD_4004 - Position: 100.0 μm - Charge: 46.99 pC - Rise Time: 0.96 ns

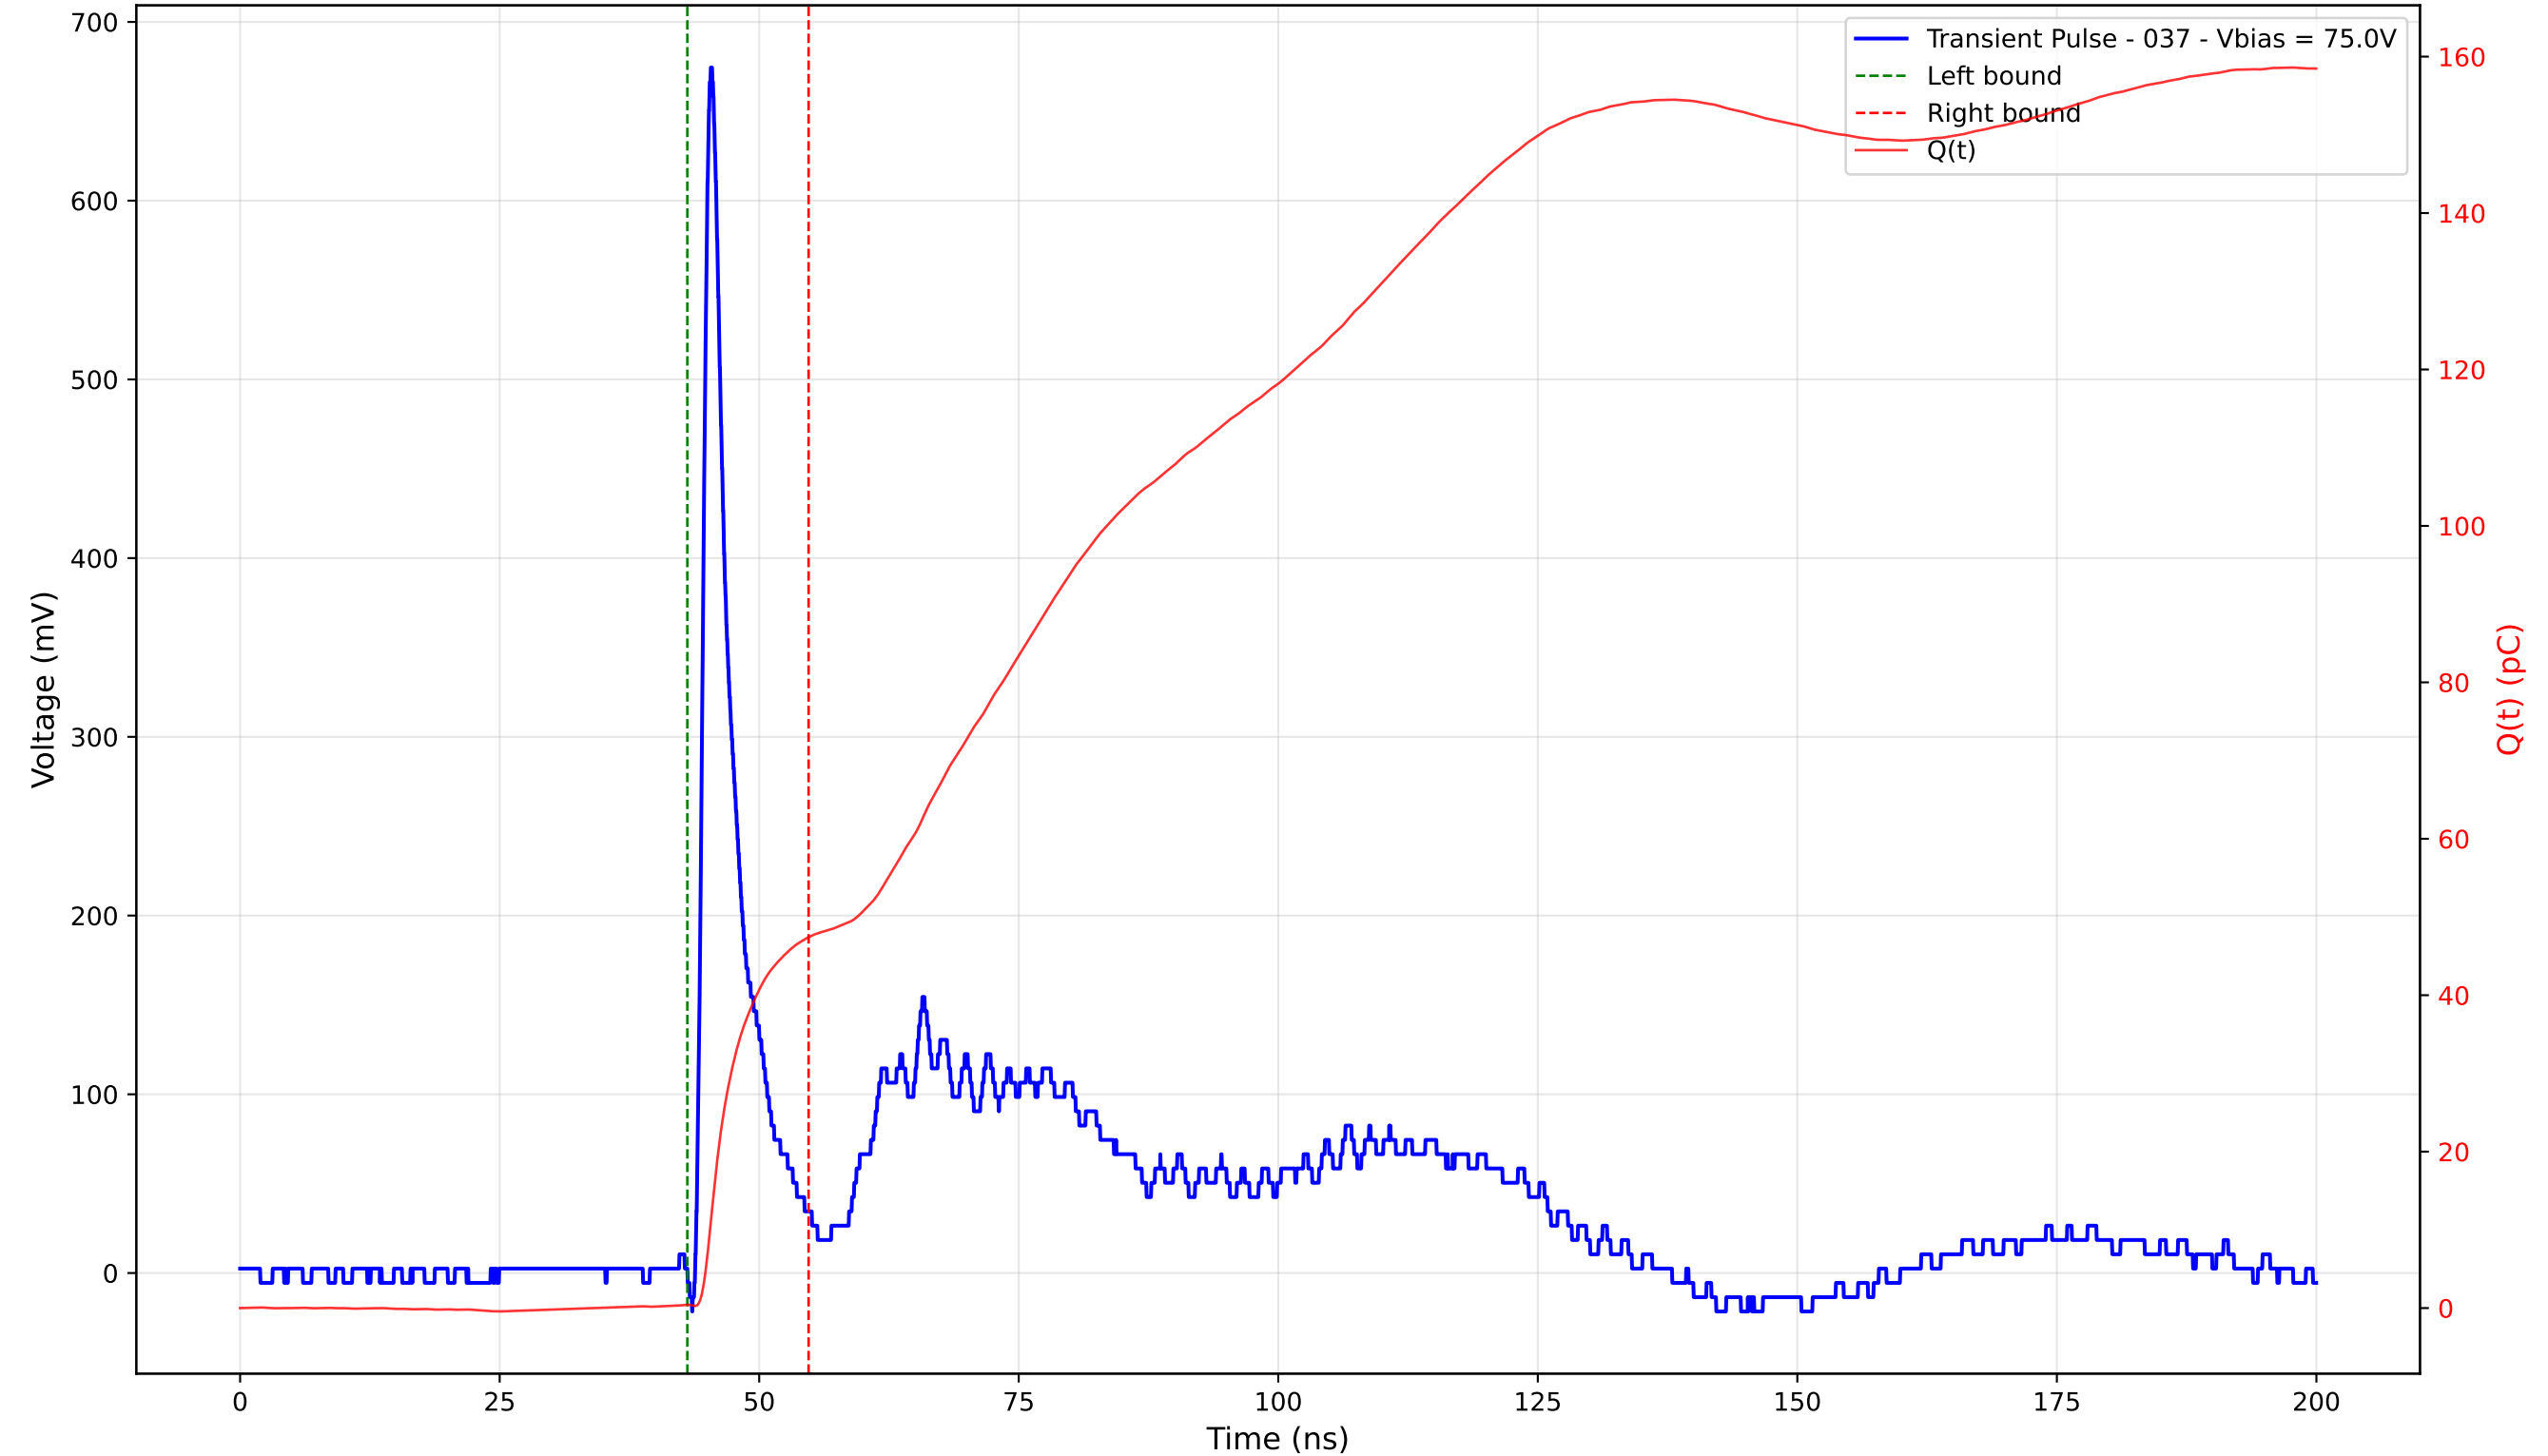


Transient Pulse - Sample: TD_4004 - Position: 105.0 μm - Charge: 48.46 pC - Rise Time: 0.94 ns

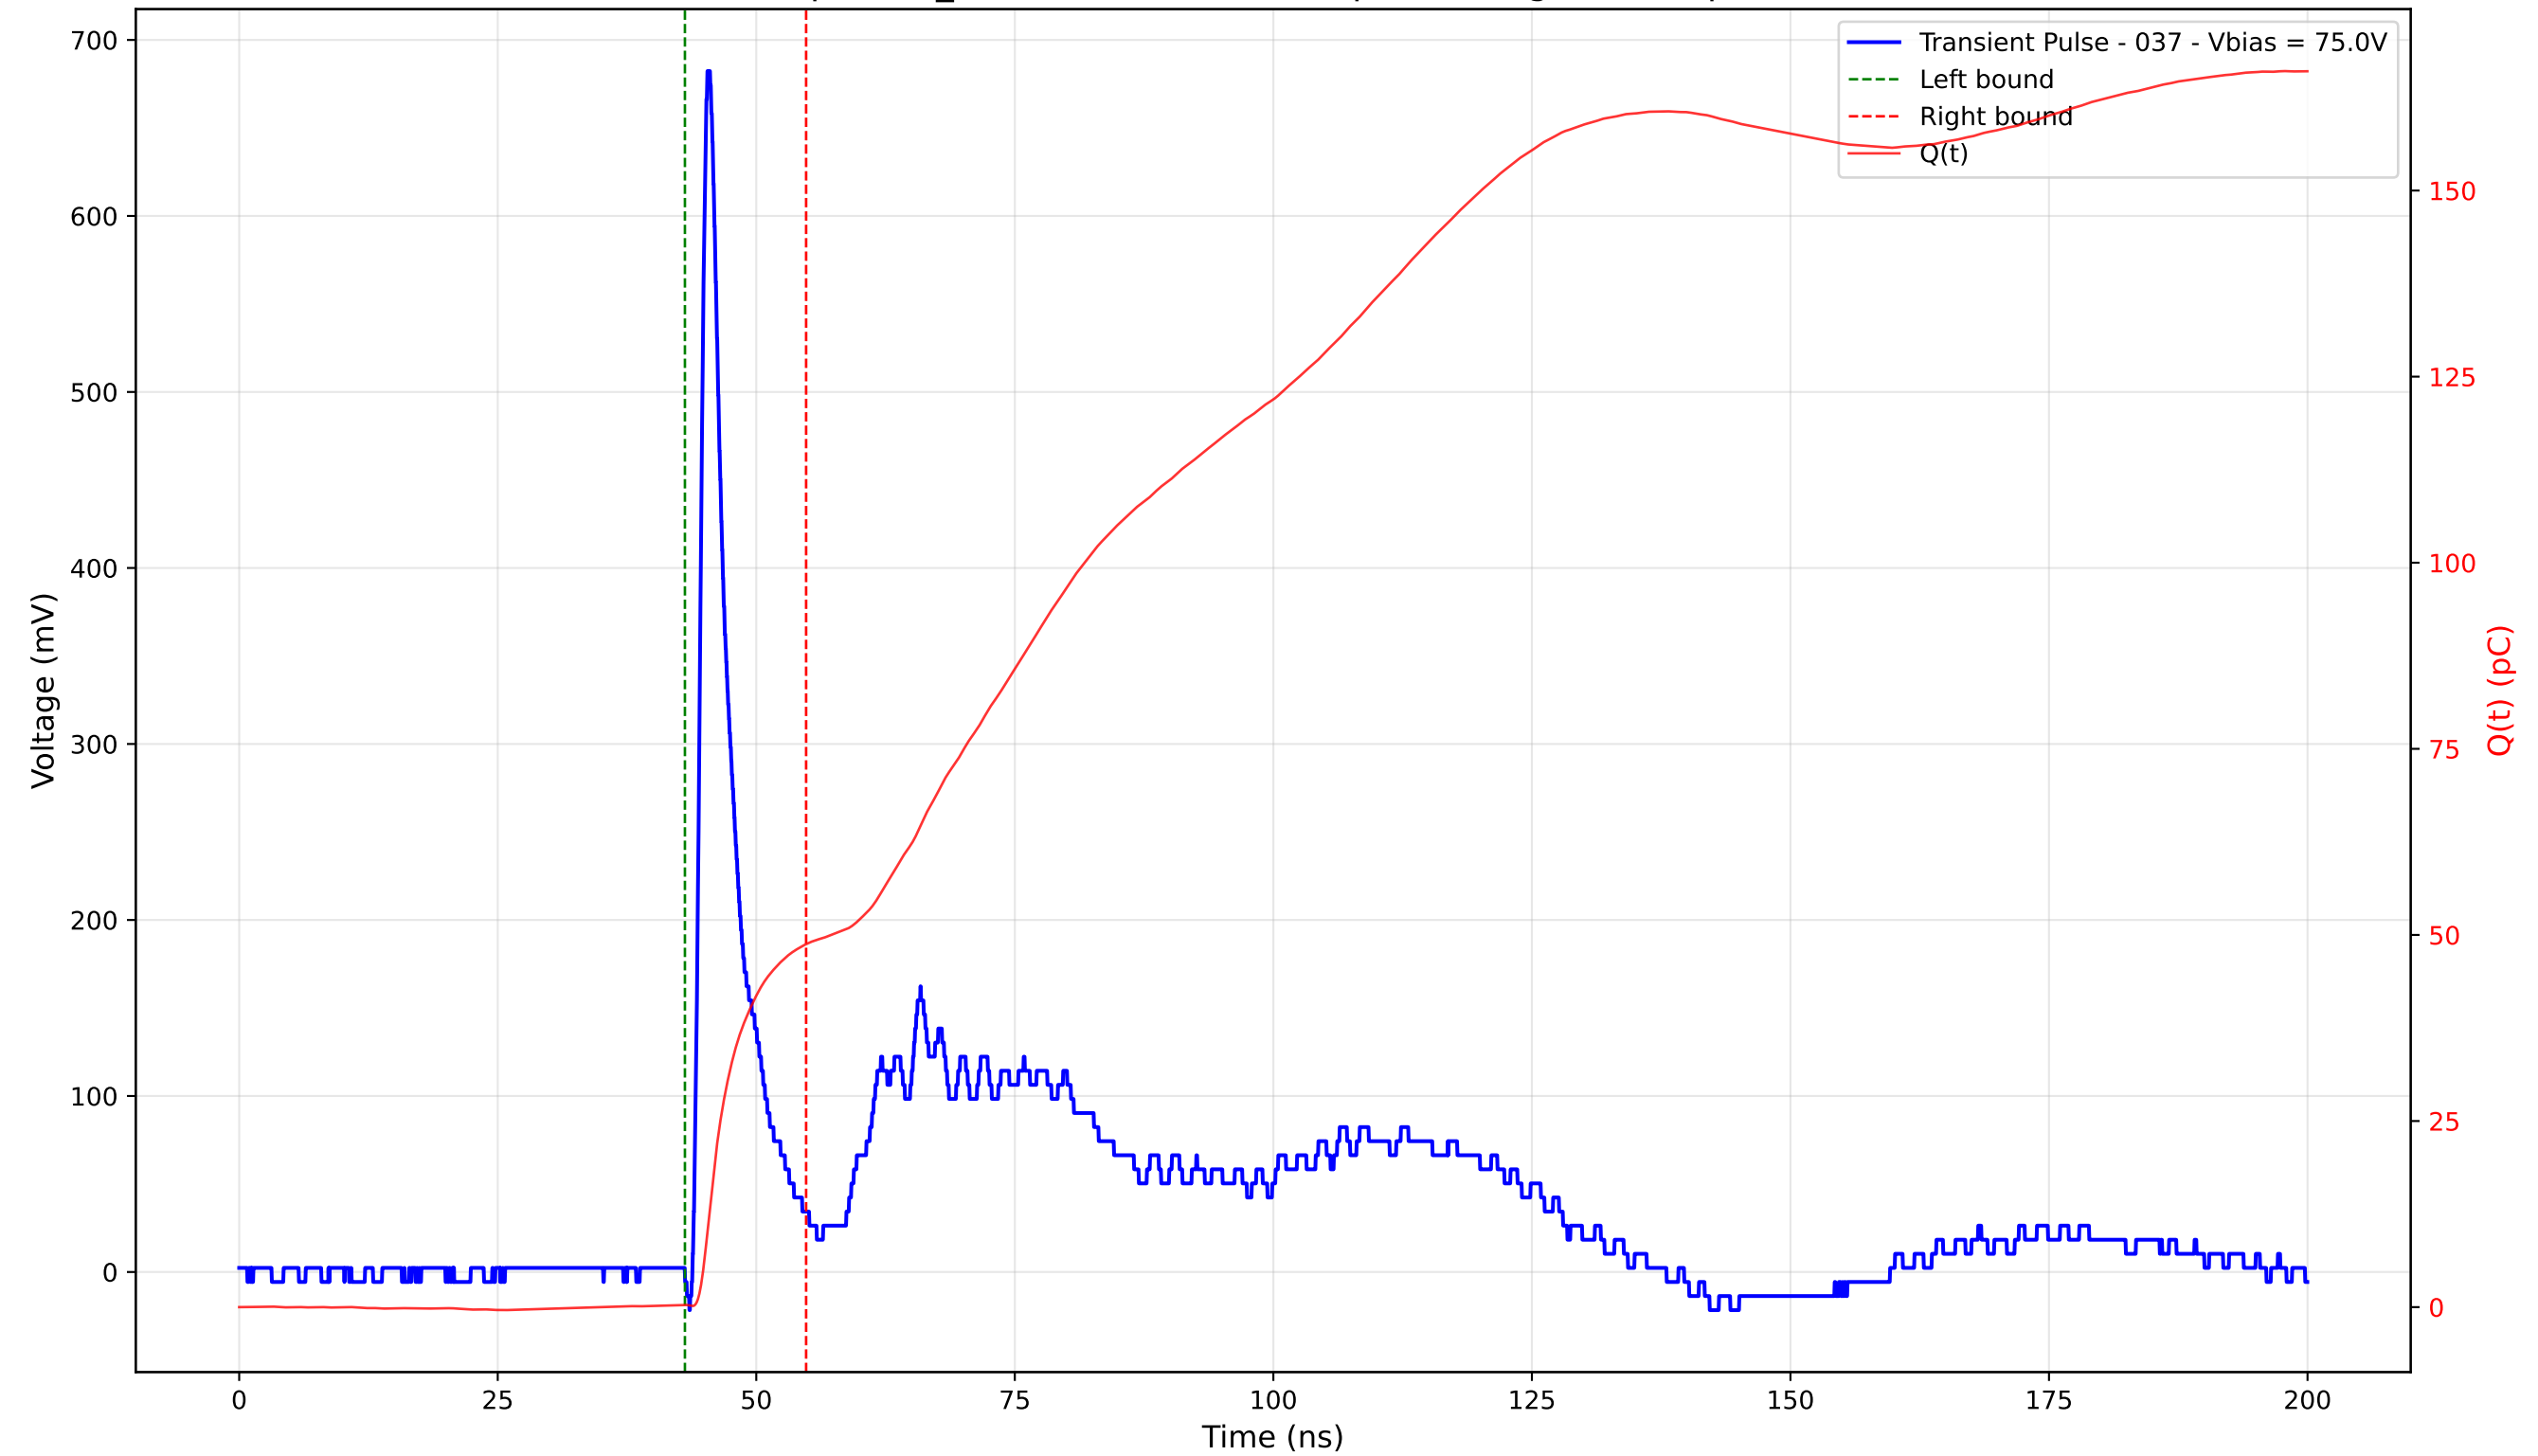


Transient Pulse - Sample: TD_4004 - Position: 110.0 μm - Charge: 49.06 pC - Rise Time: 0.96 ns

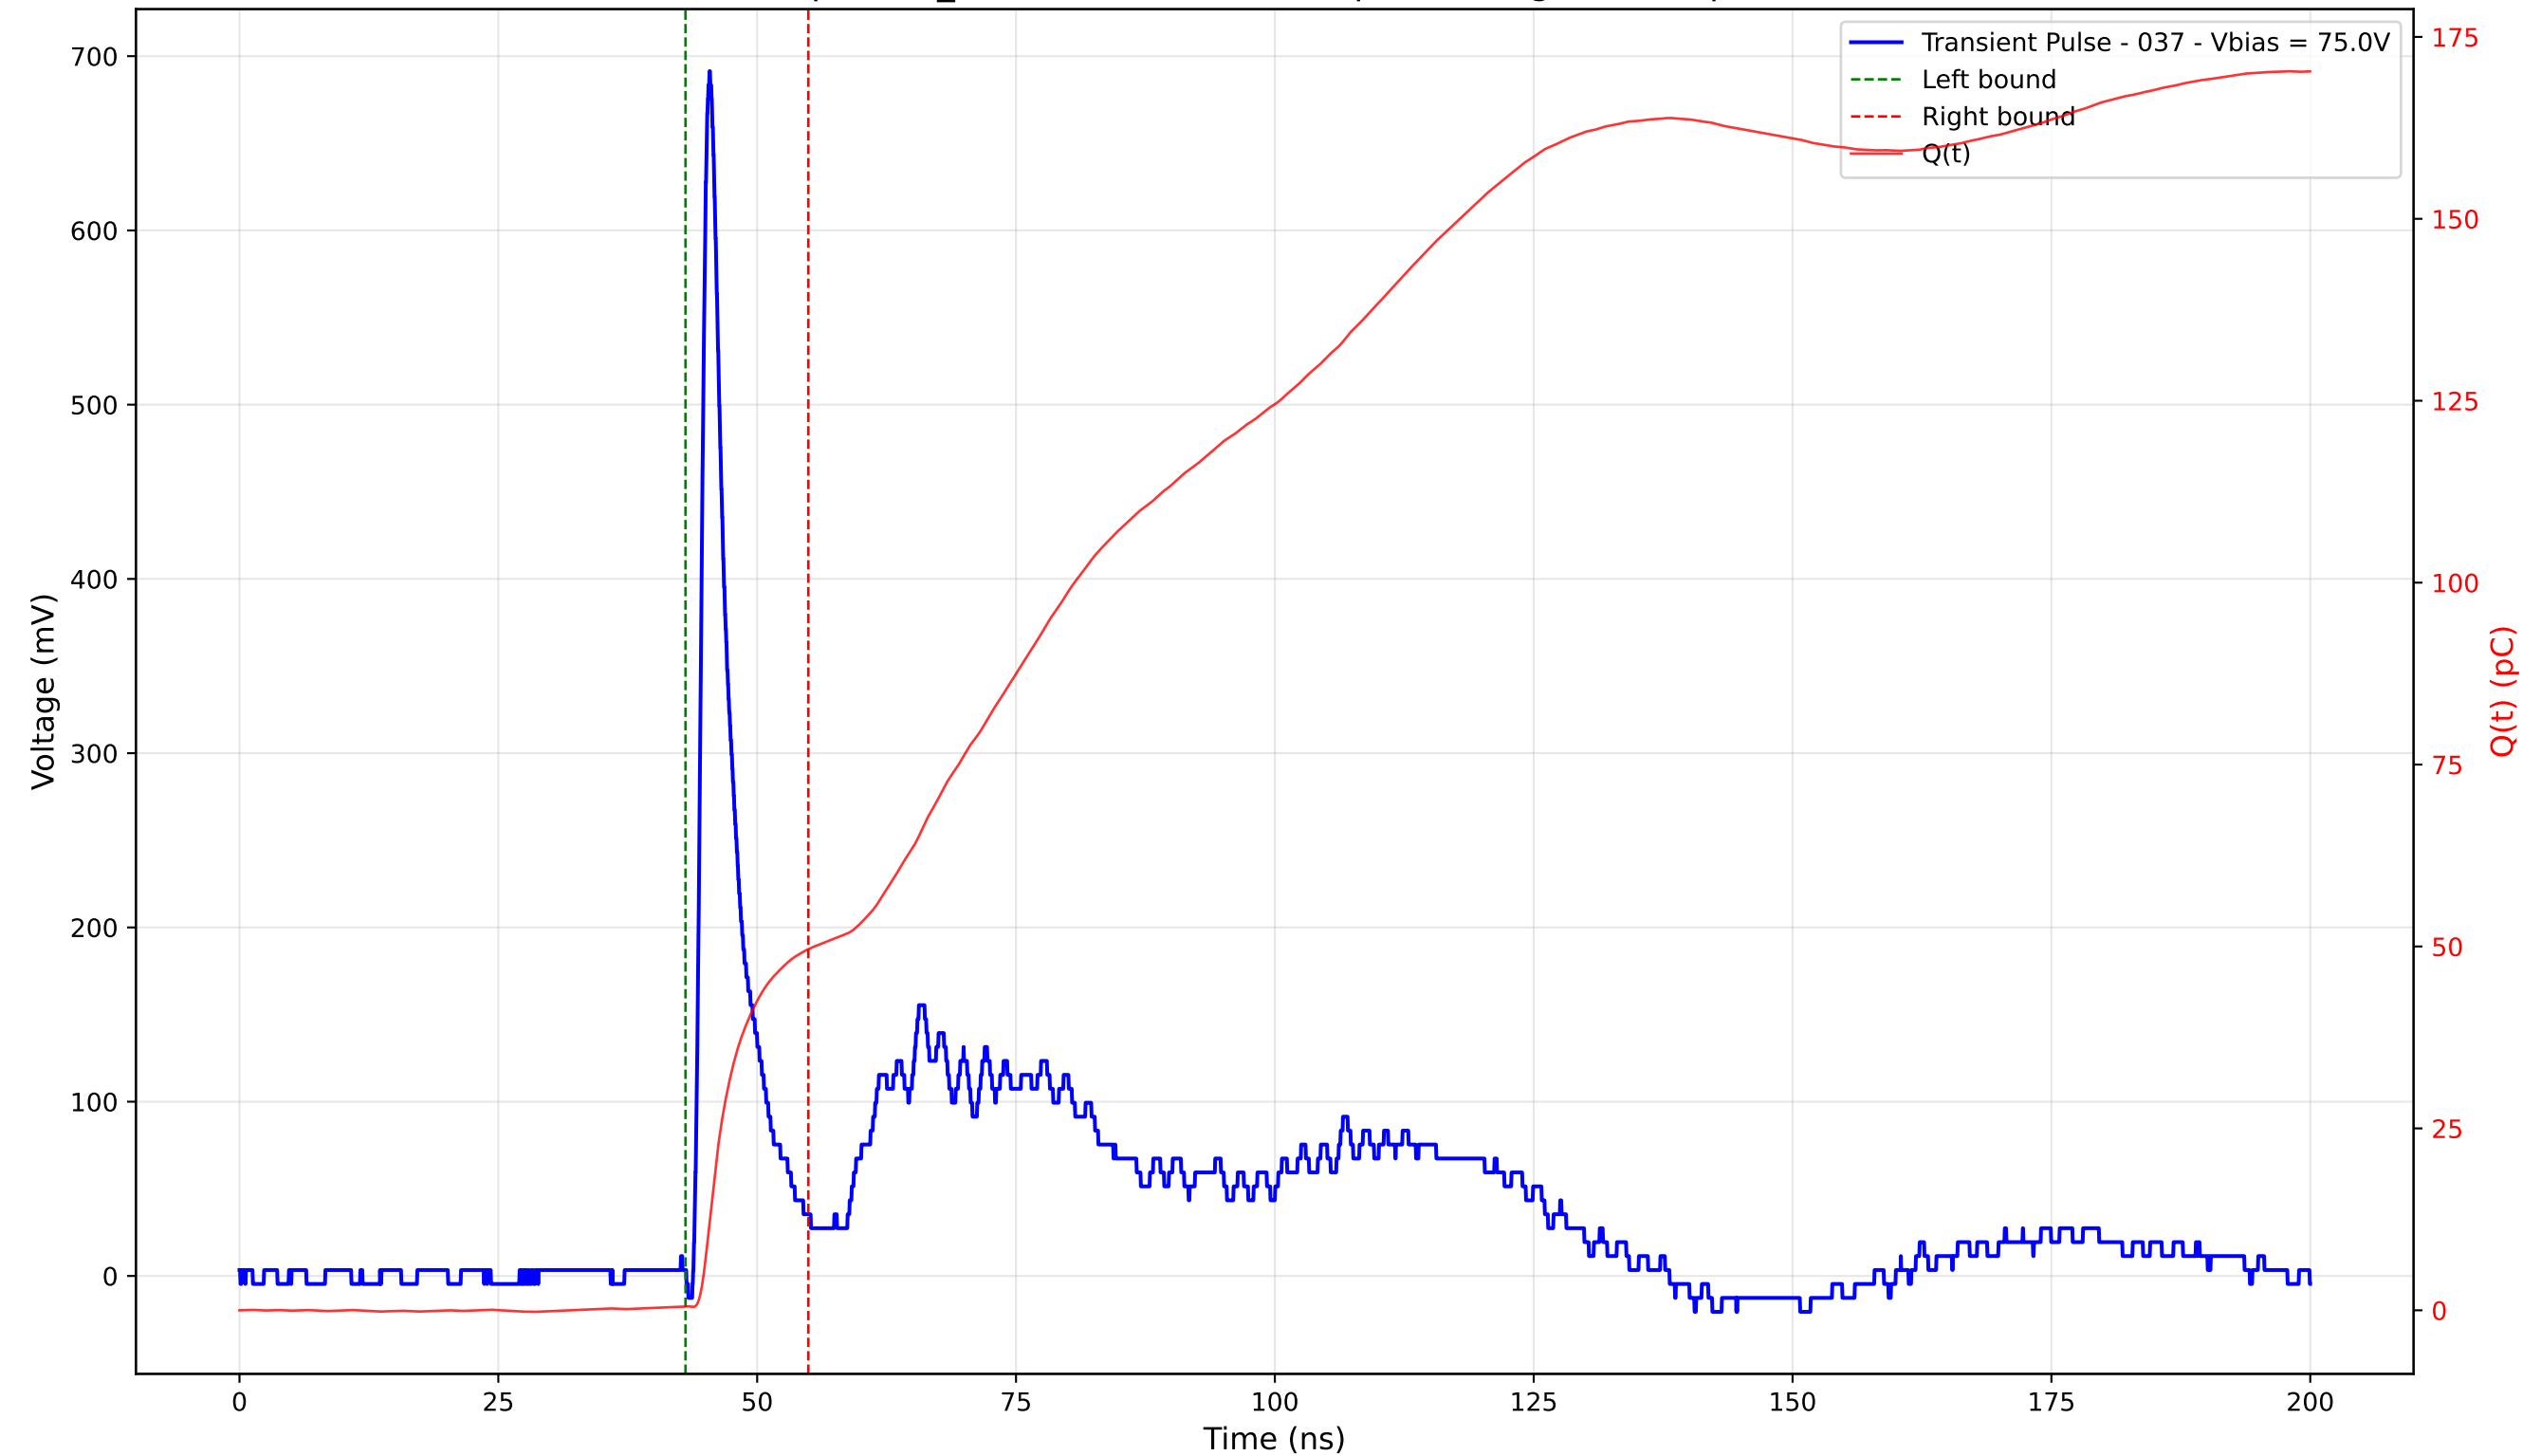


Transient Pulse - Sample: TD_4004 - Position: 115.0 μm - Charge: 48.27 pC - Rise Time: 0.97 ns

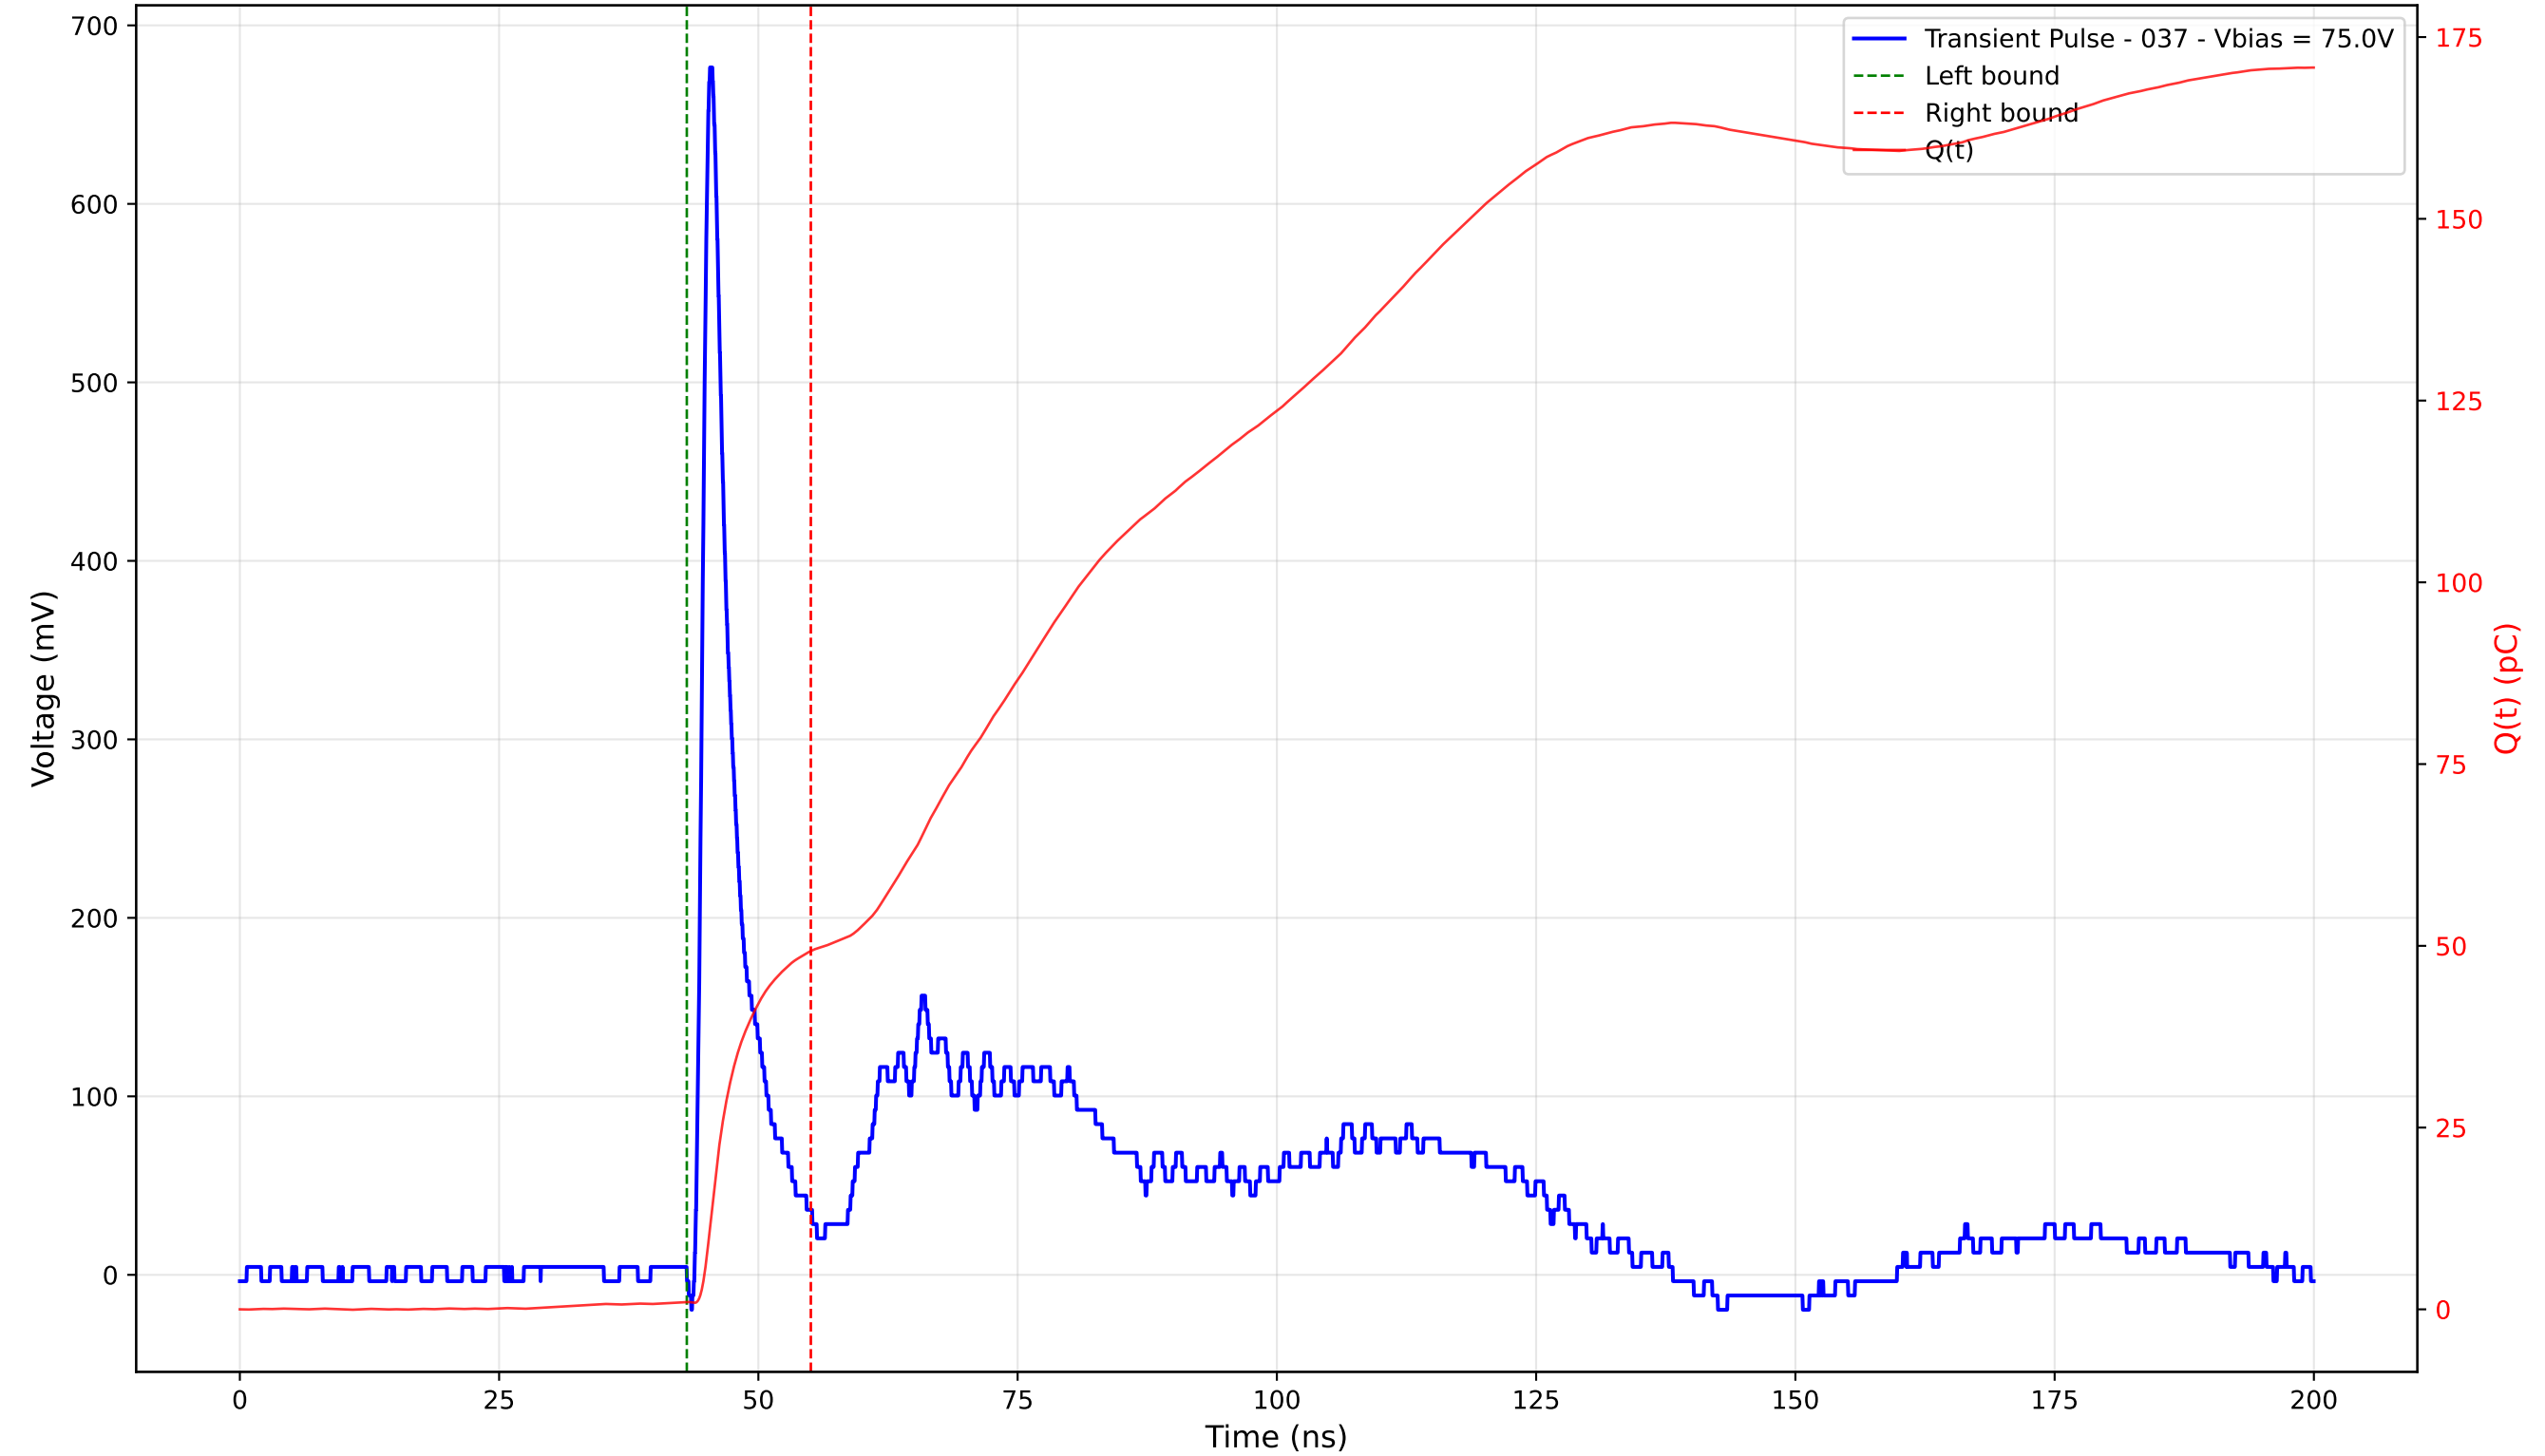


Transient Pulse - Sample: TD_4004 - Position: 120.0 μm - Charge: 45.84 pC - Rise Time: 0.98 ns

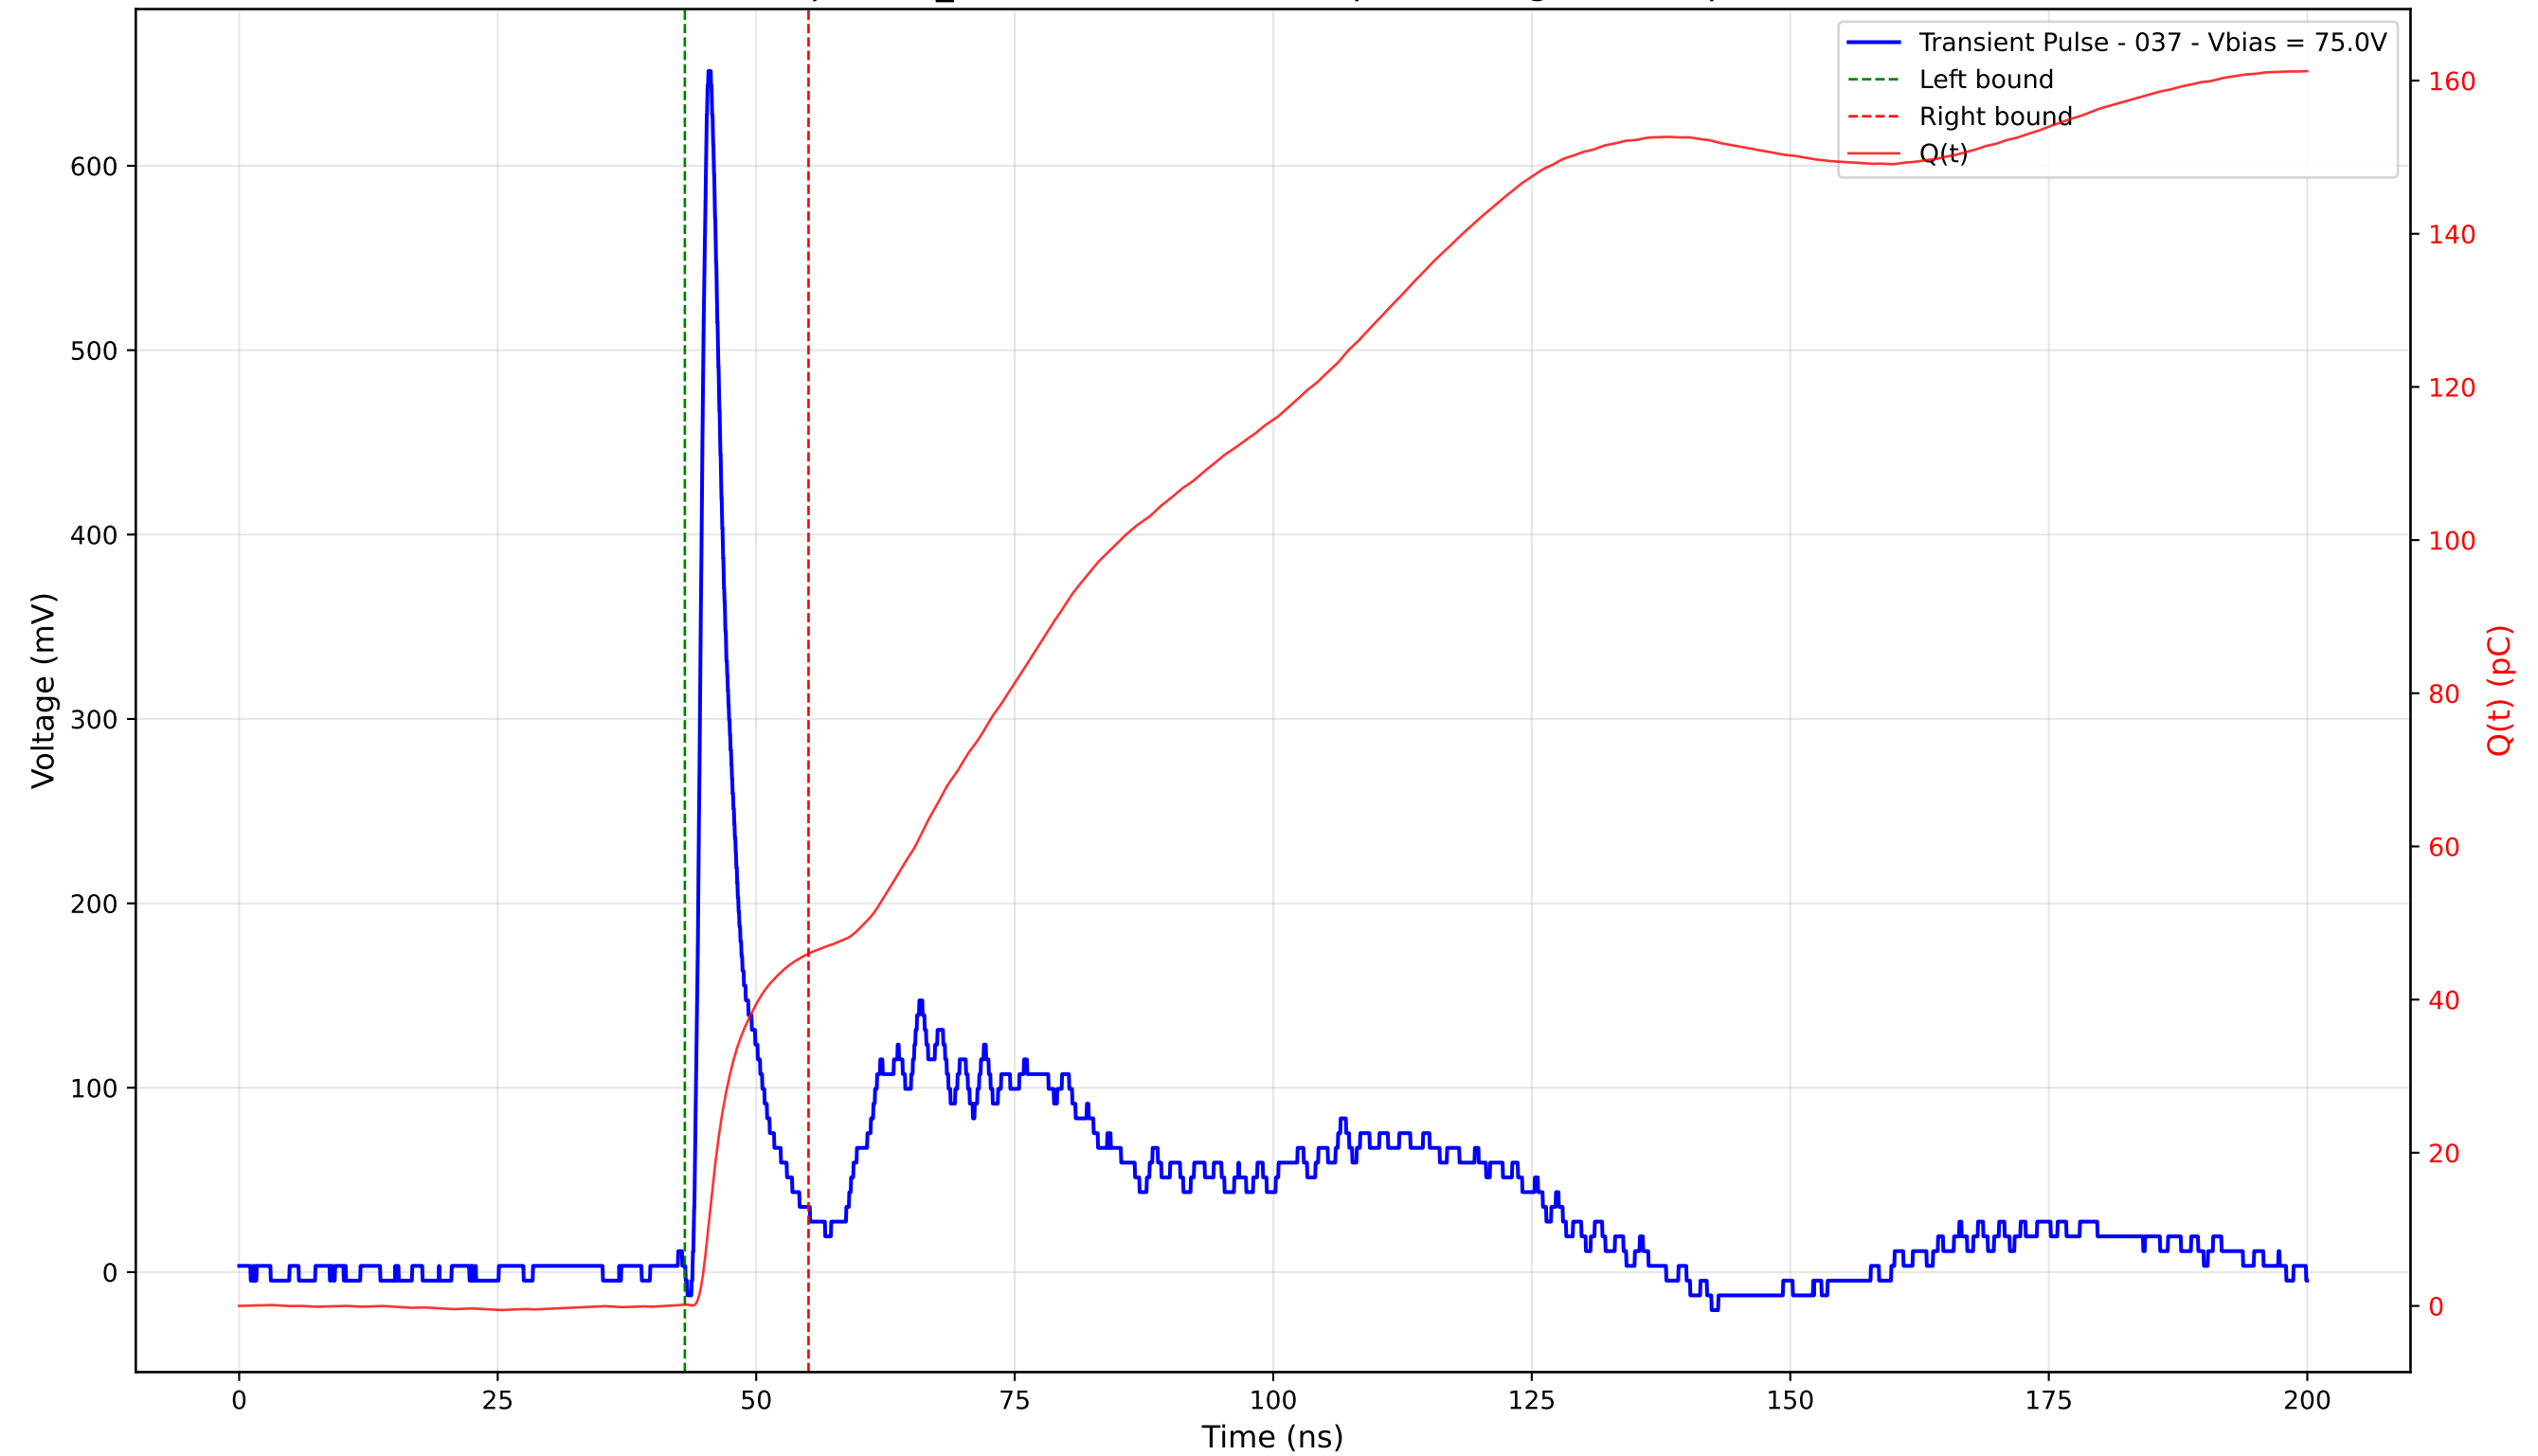


Transient Pulse - Sample: TD_4004 - Position: 125.0 μm - Charge: 41.75 pC - Rise Time: 1.00 ns

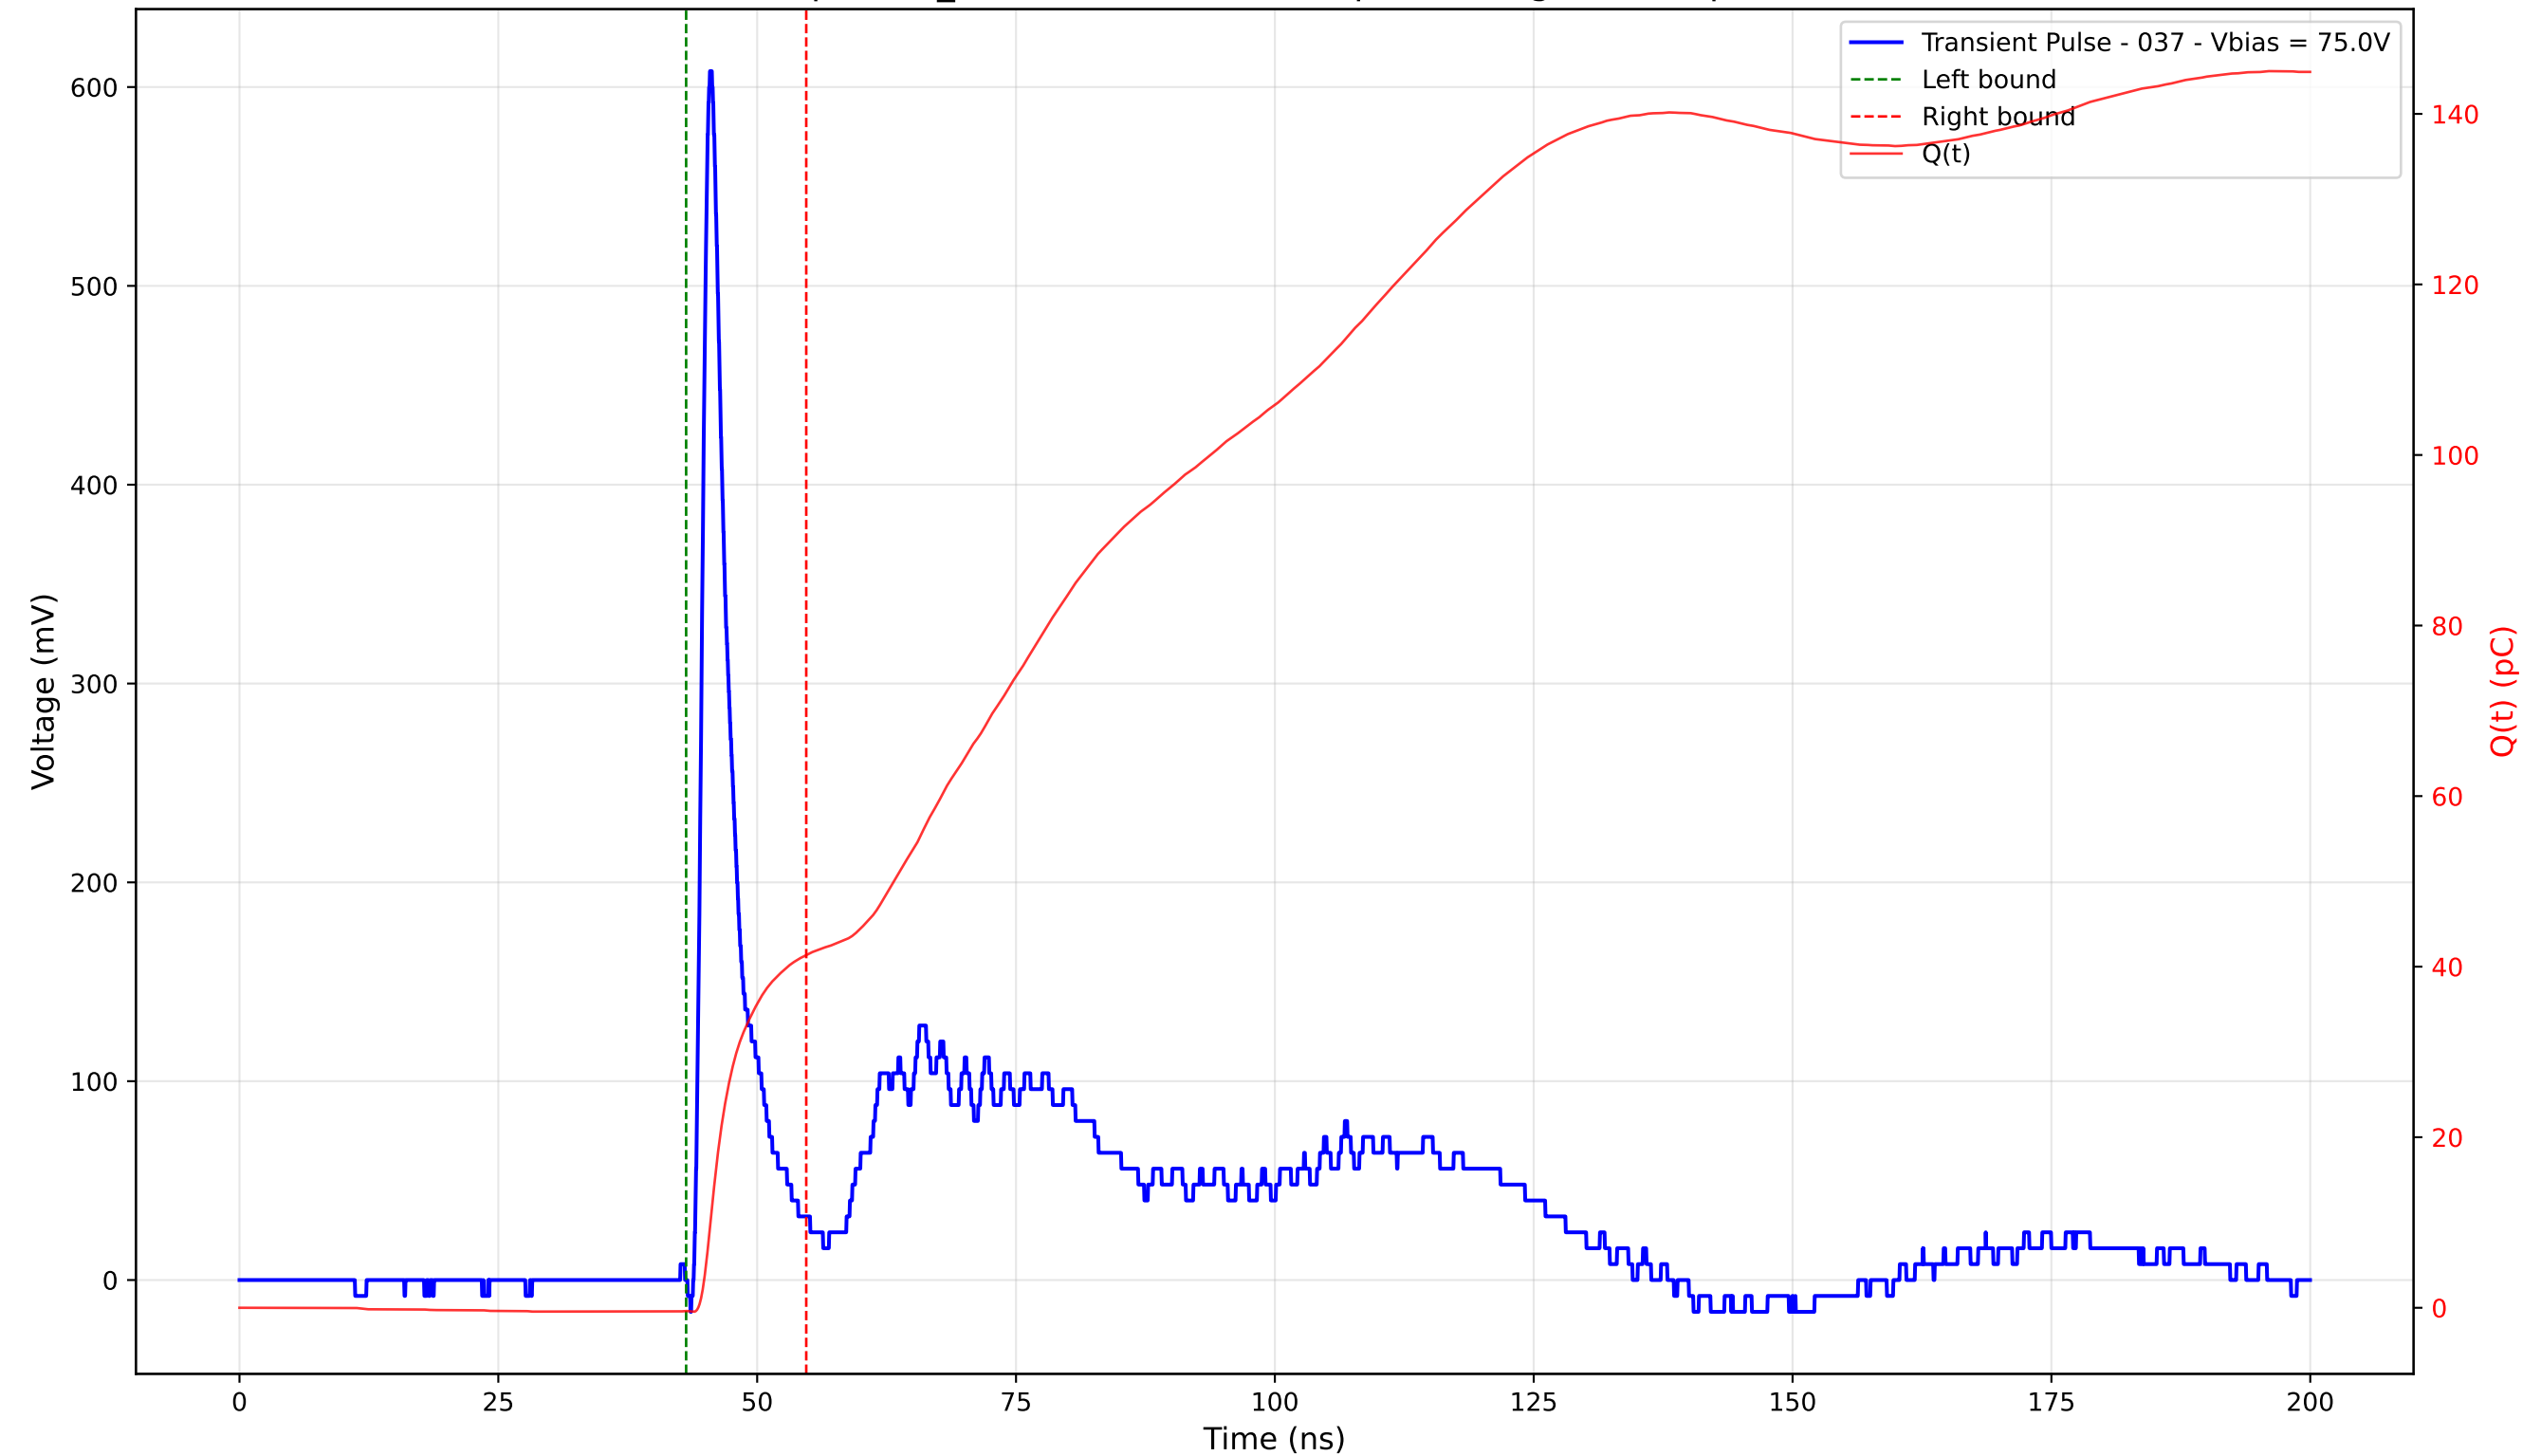


Transient Pulse - Sample: TD_4004 - Position: 130.0 μm - Charge: 38.00 pC - Rise Time: 1.05 ns

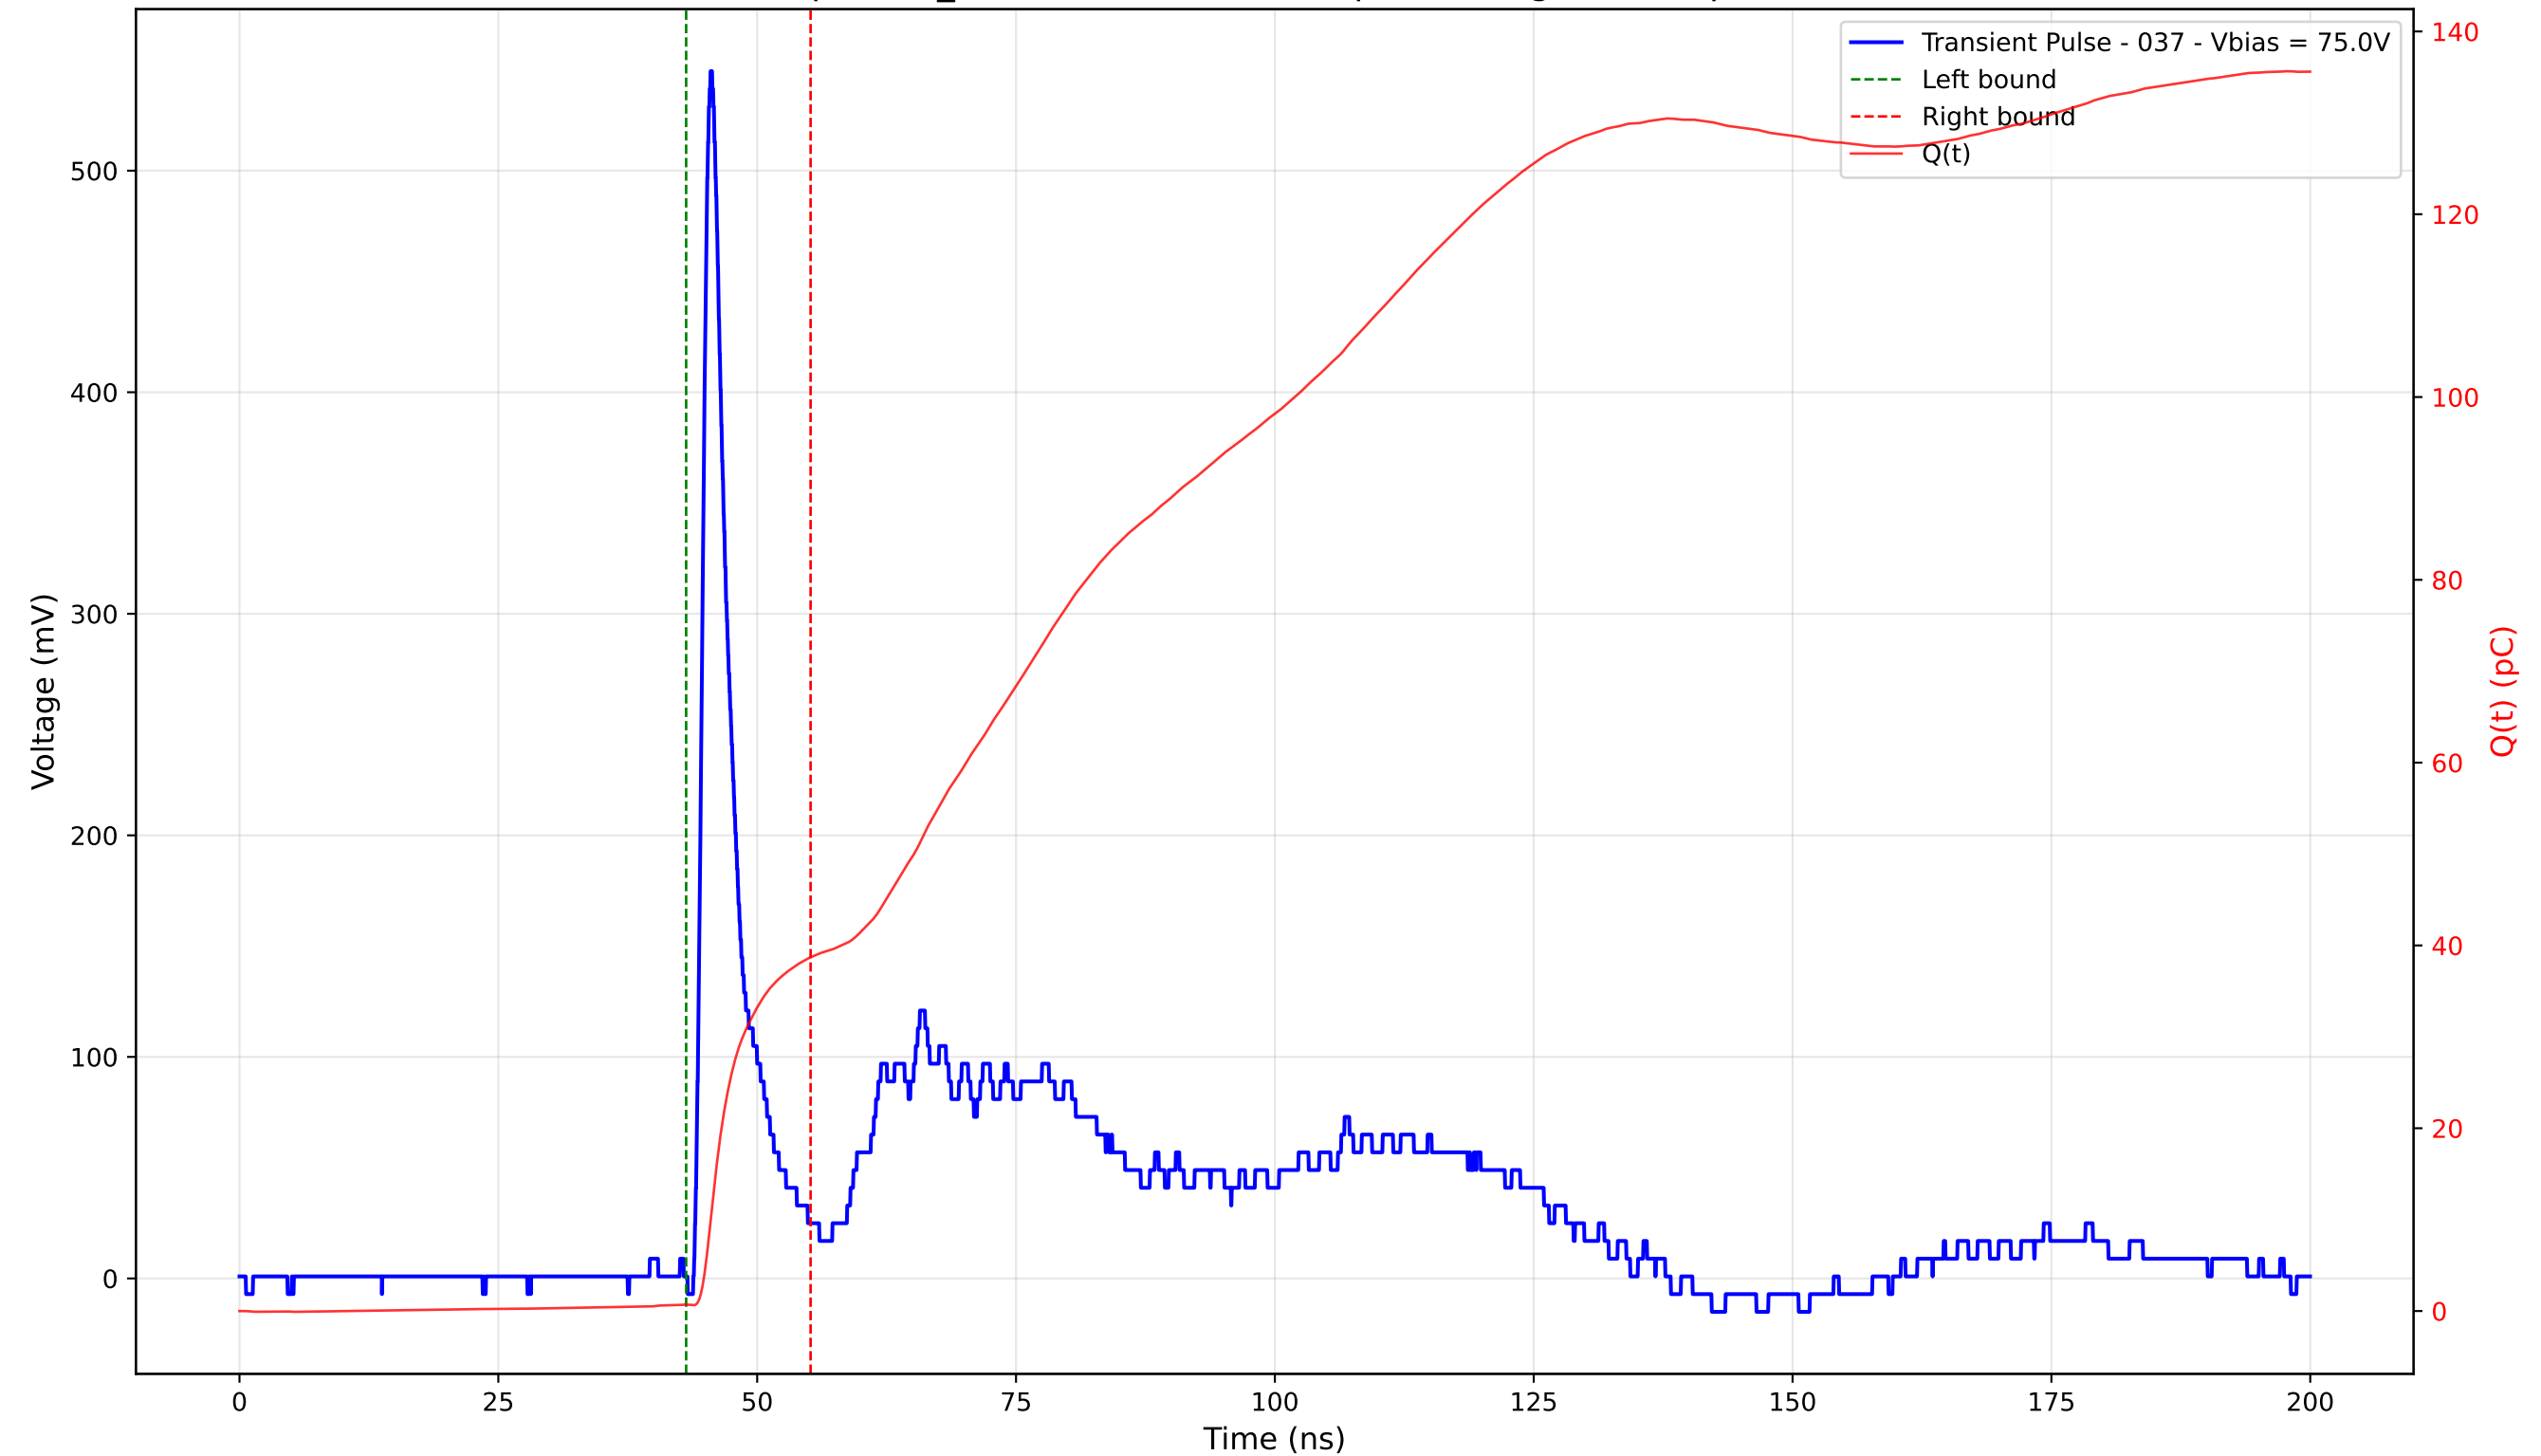


Transient Pulse - Sample: TD_4004 - Position: 135.0 μm - Charge: 35.49 pC - Rise Time: 1.06 ns

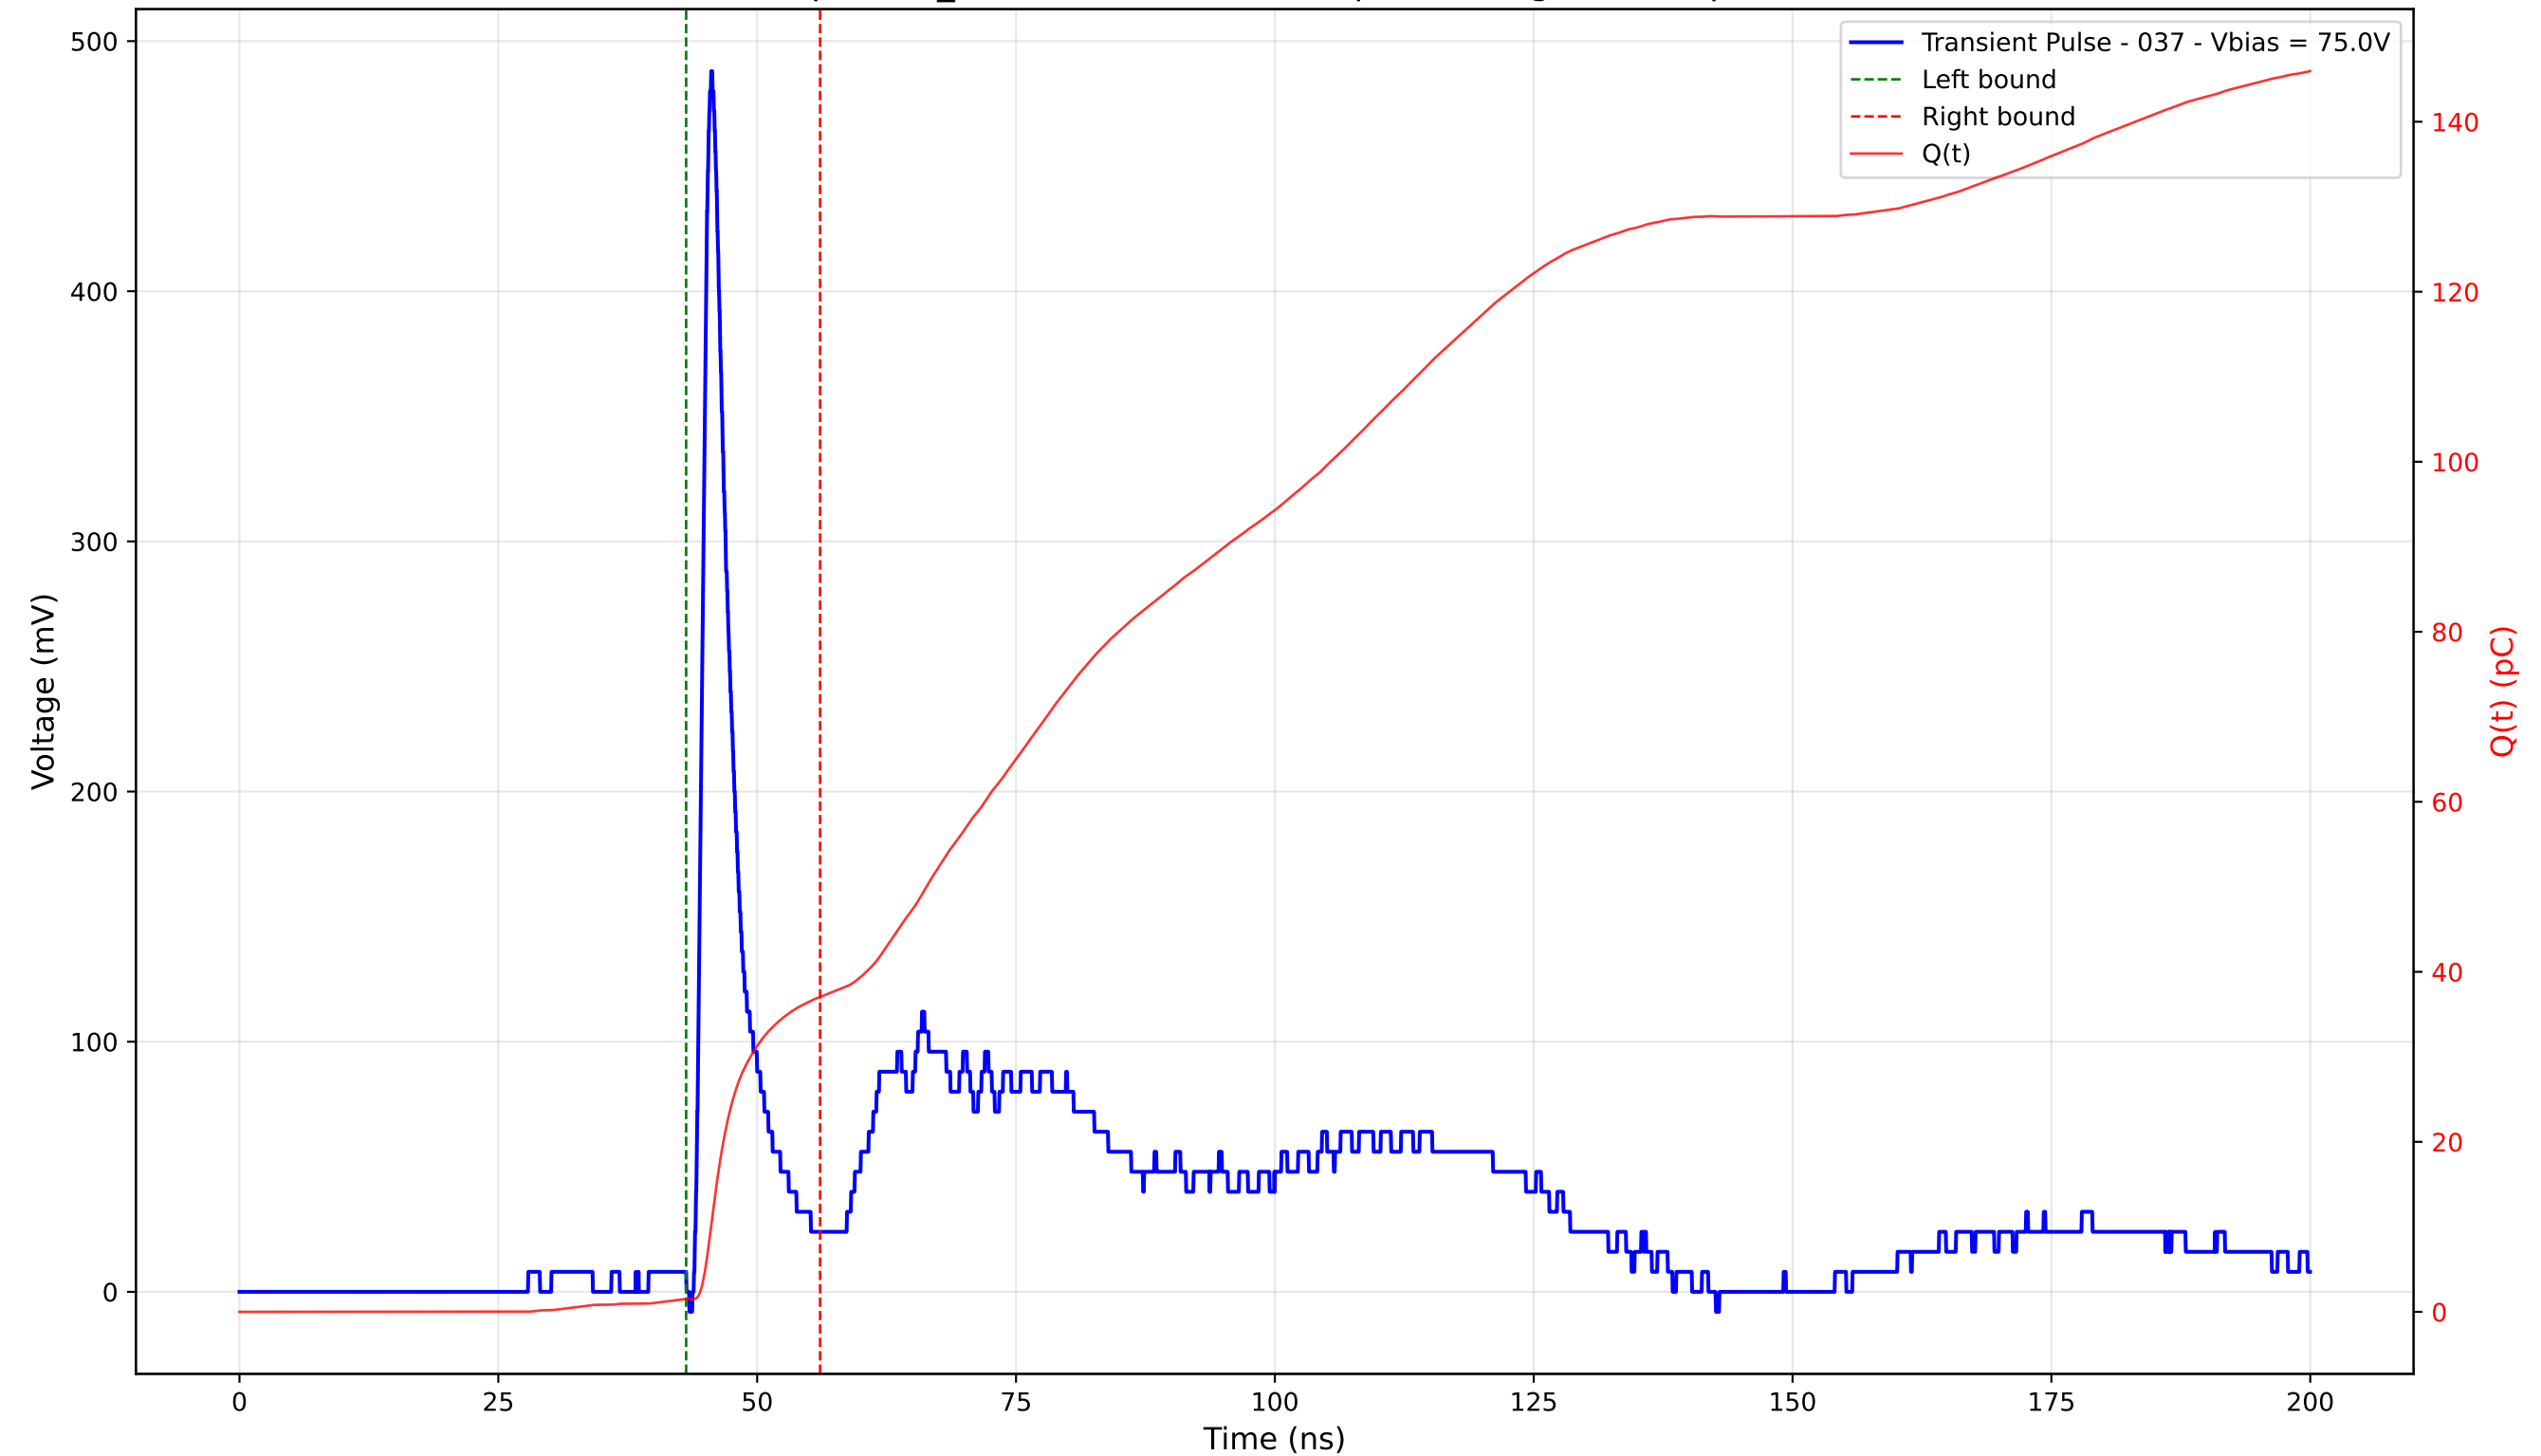


Transient Pulse - Sample: TD_4004 - Position: 140.0 μm - Charge: 32.67 pC - Rise Time: 1.07 ns

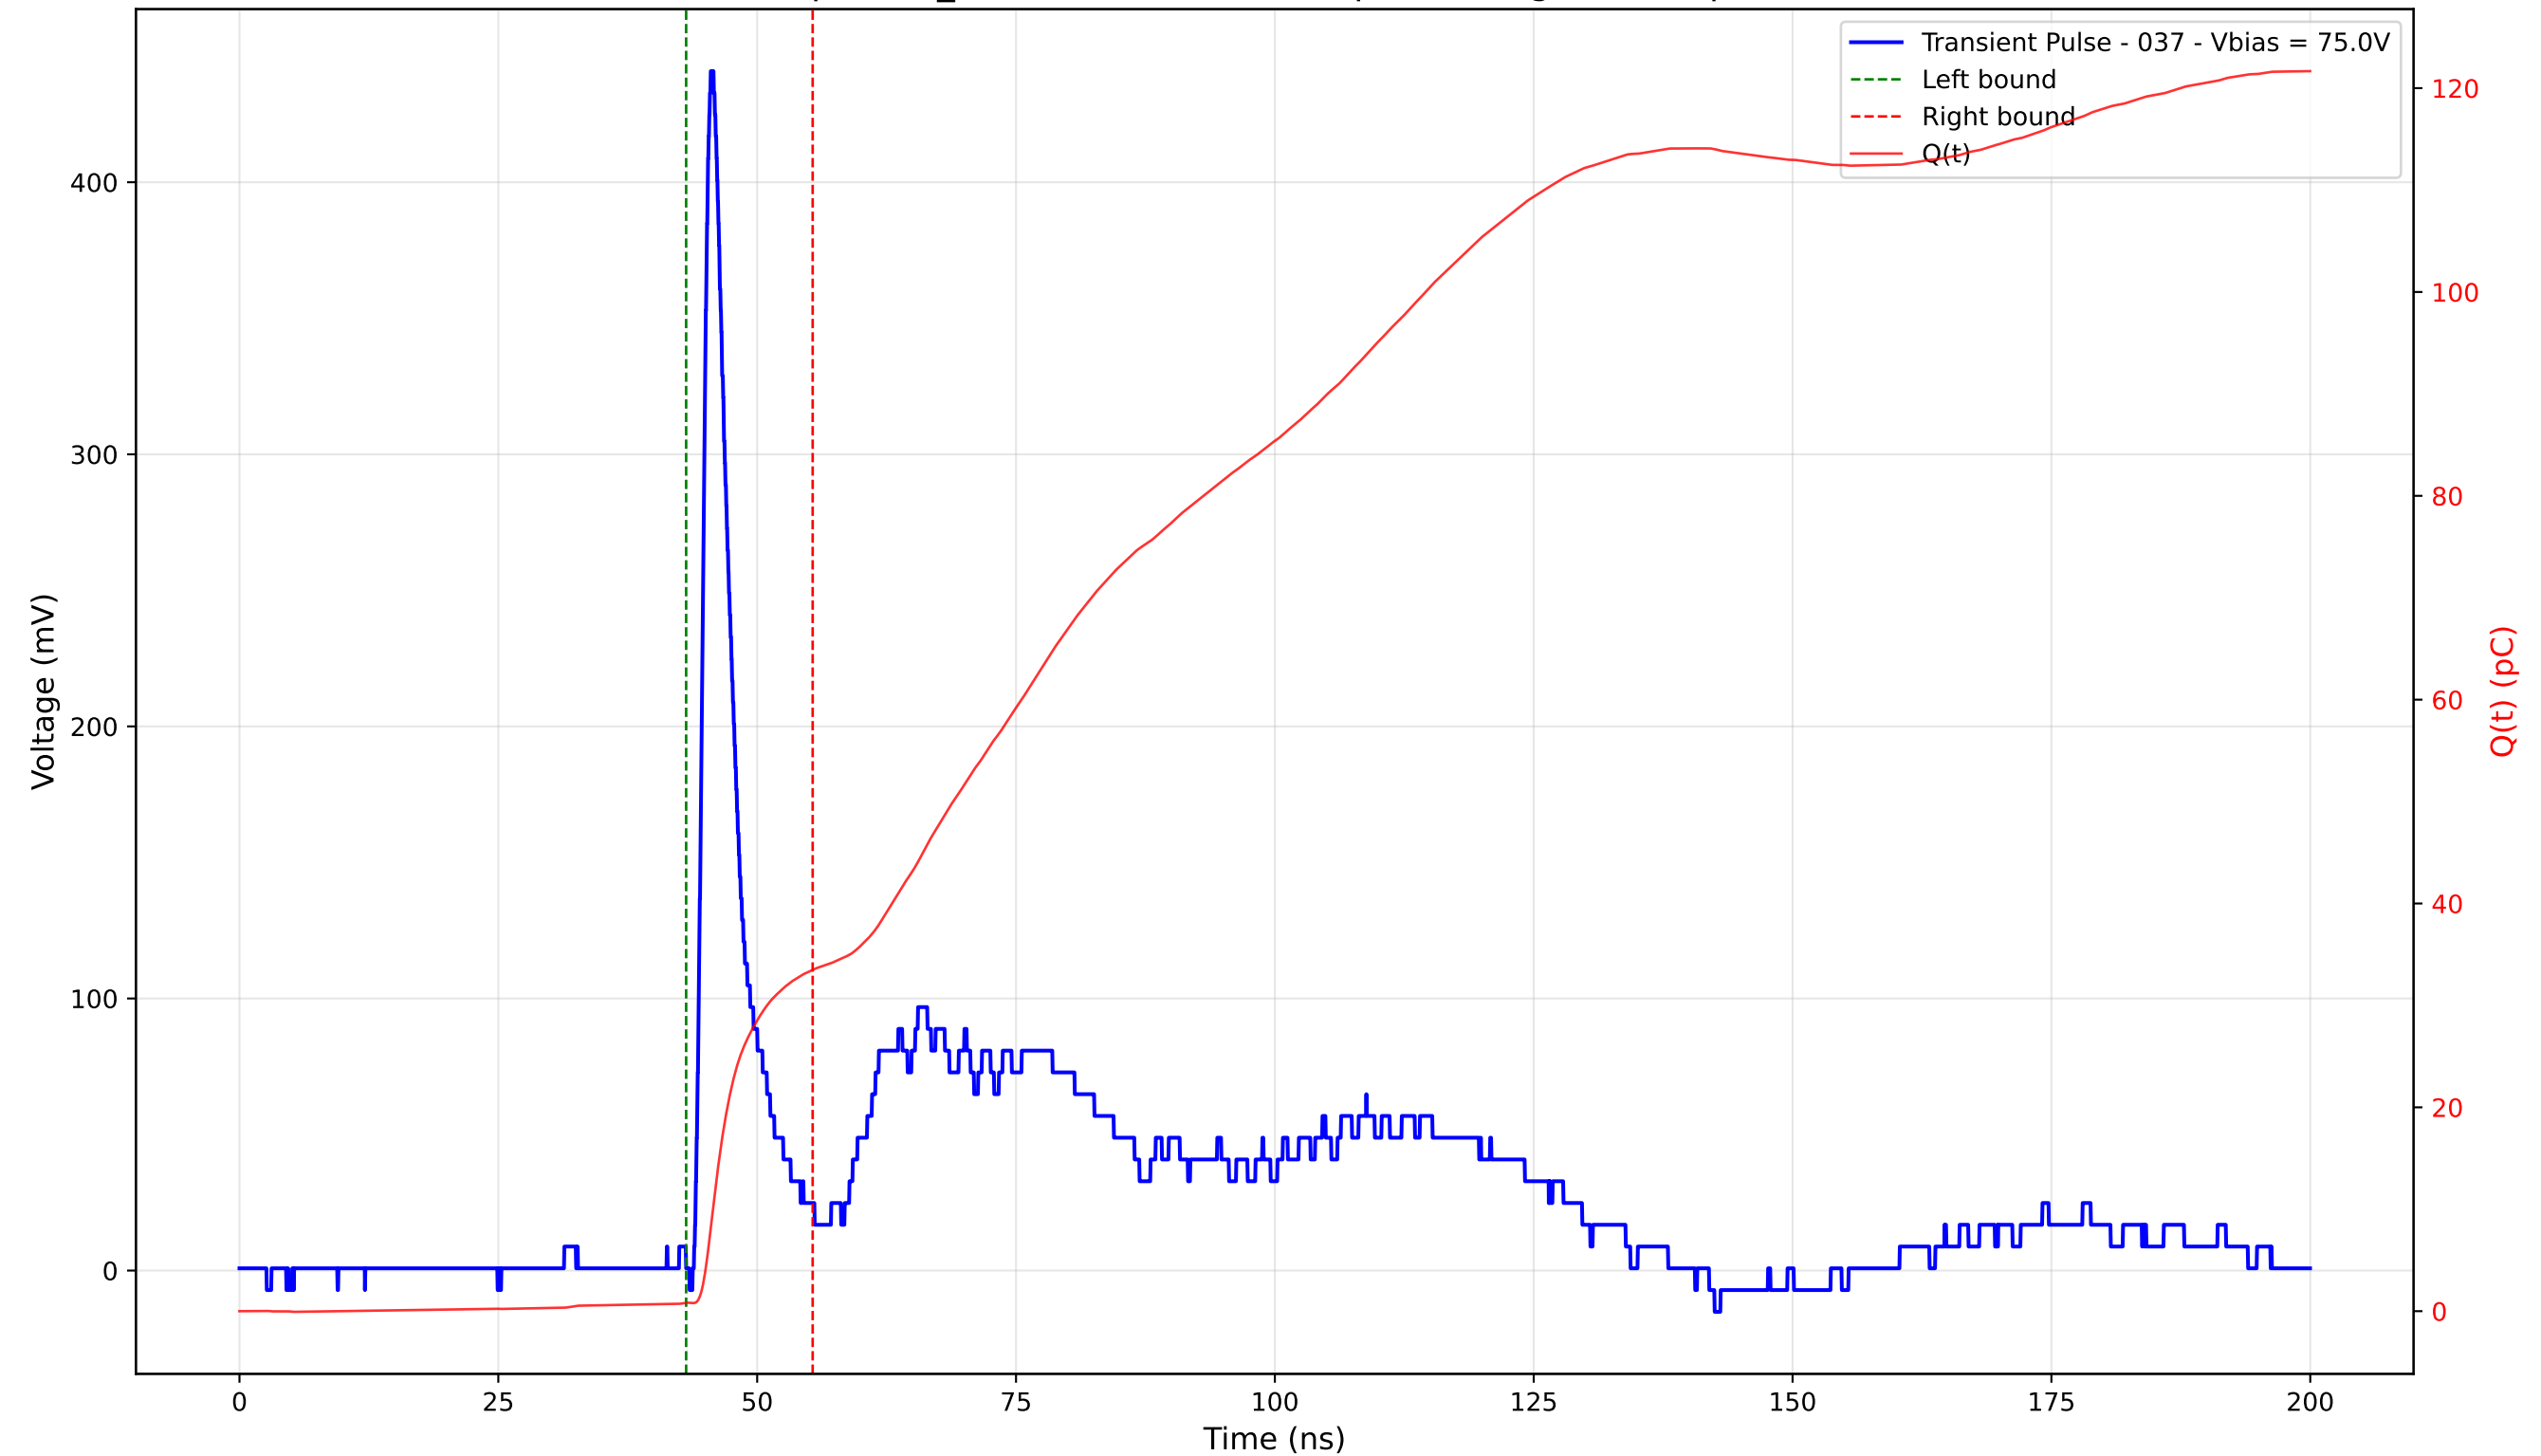


Transient Pulse - Sample: TD_4004 - Position: 145.0 μm - Charge: 32.97 pC - Rise Time: 1.08 ns

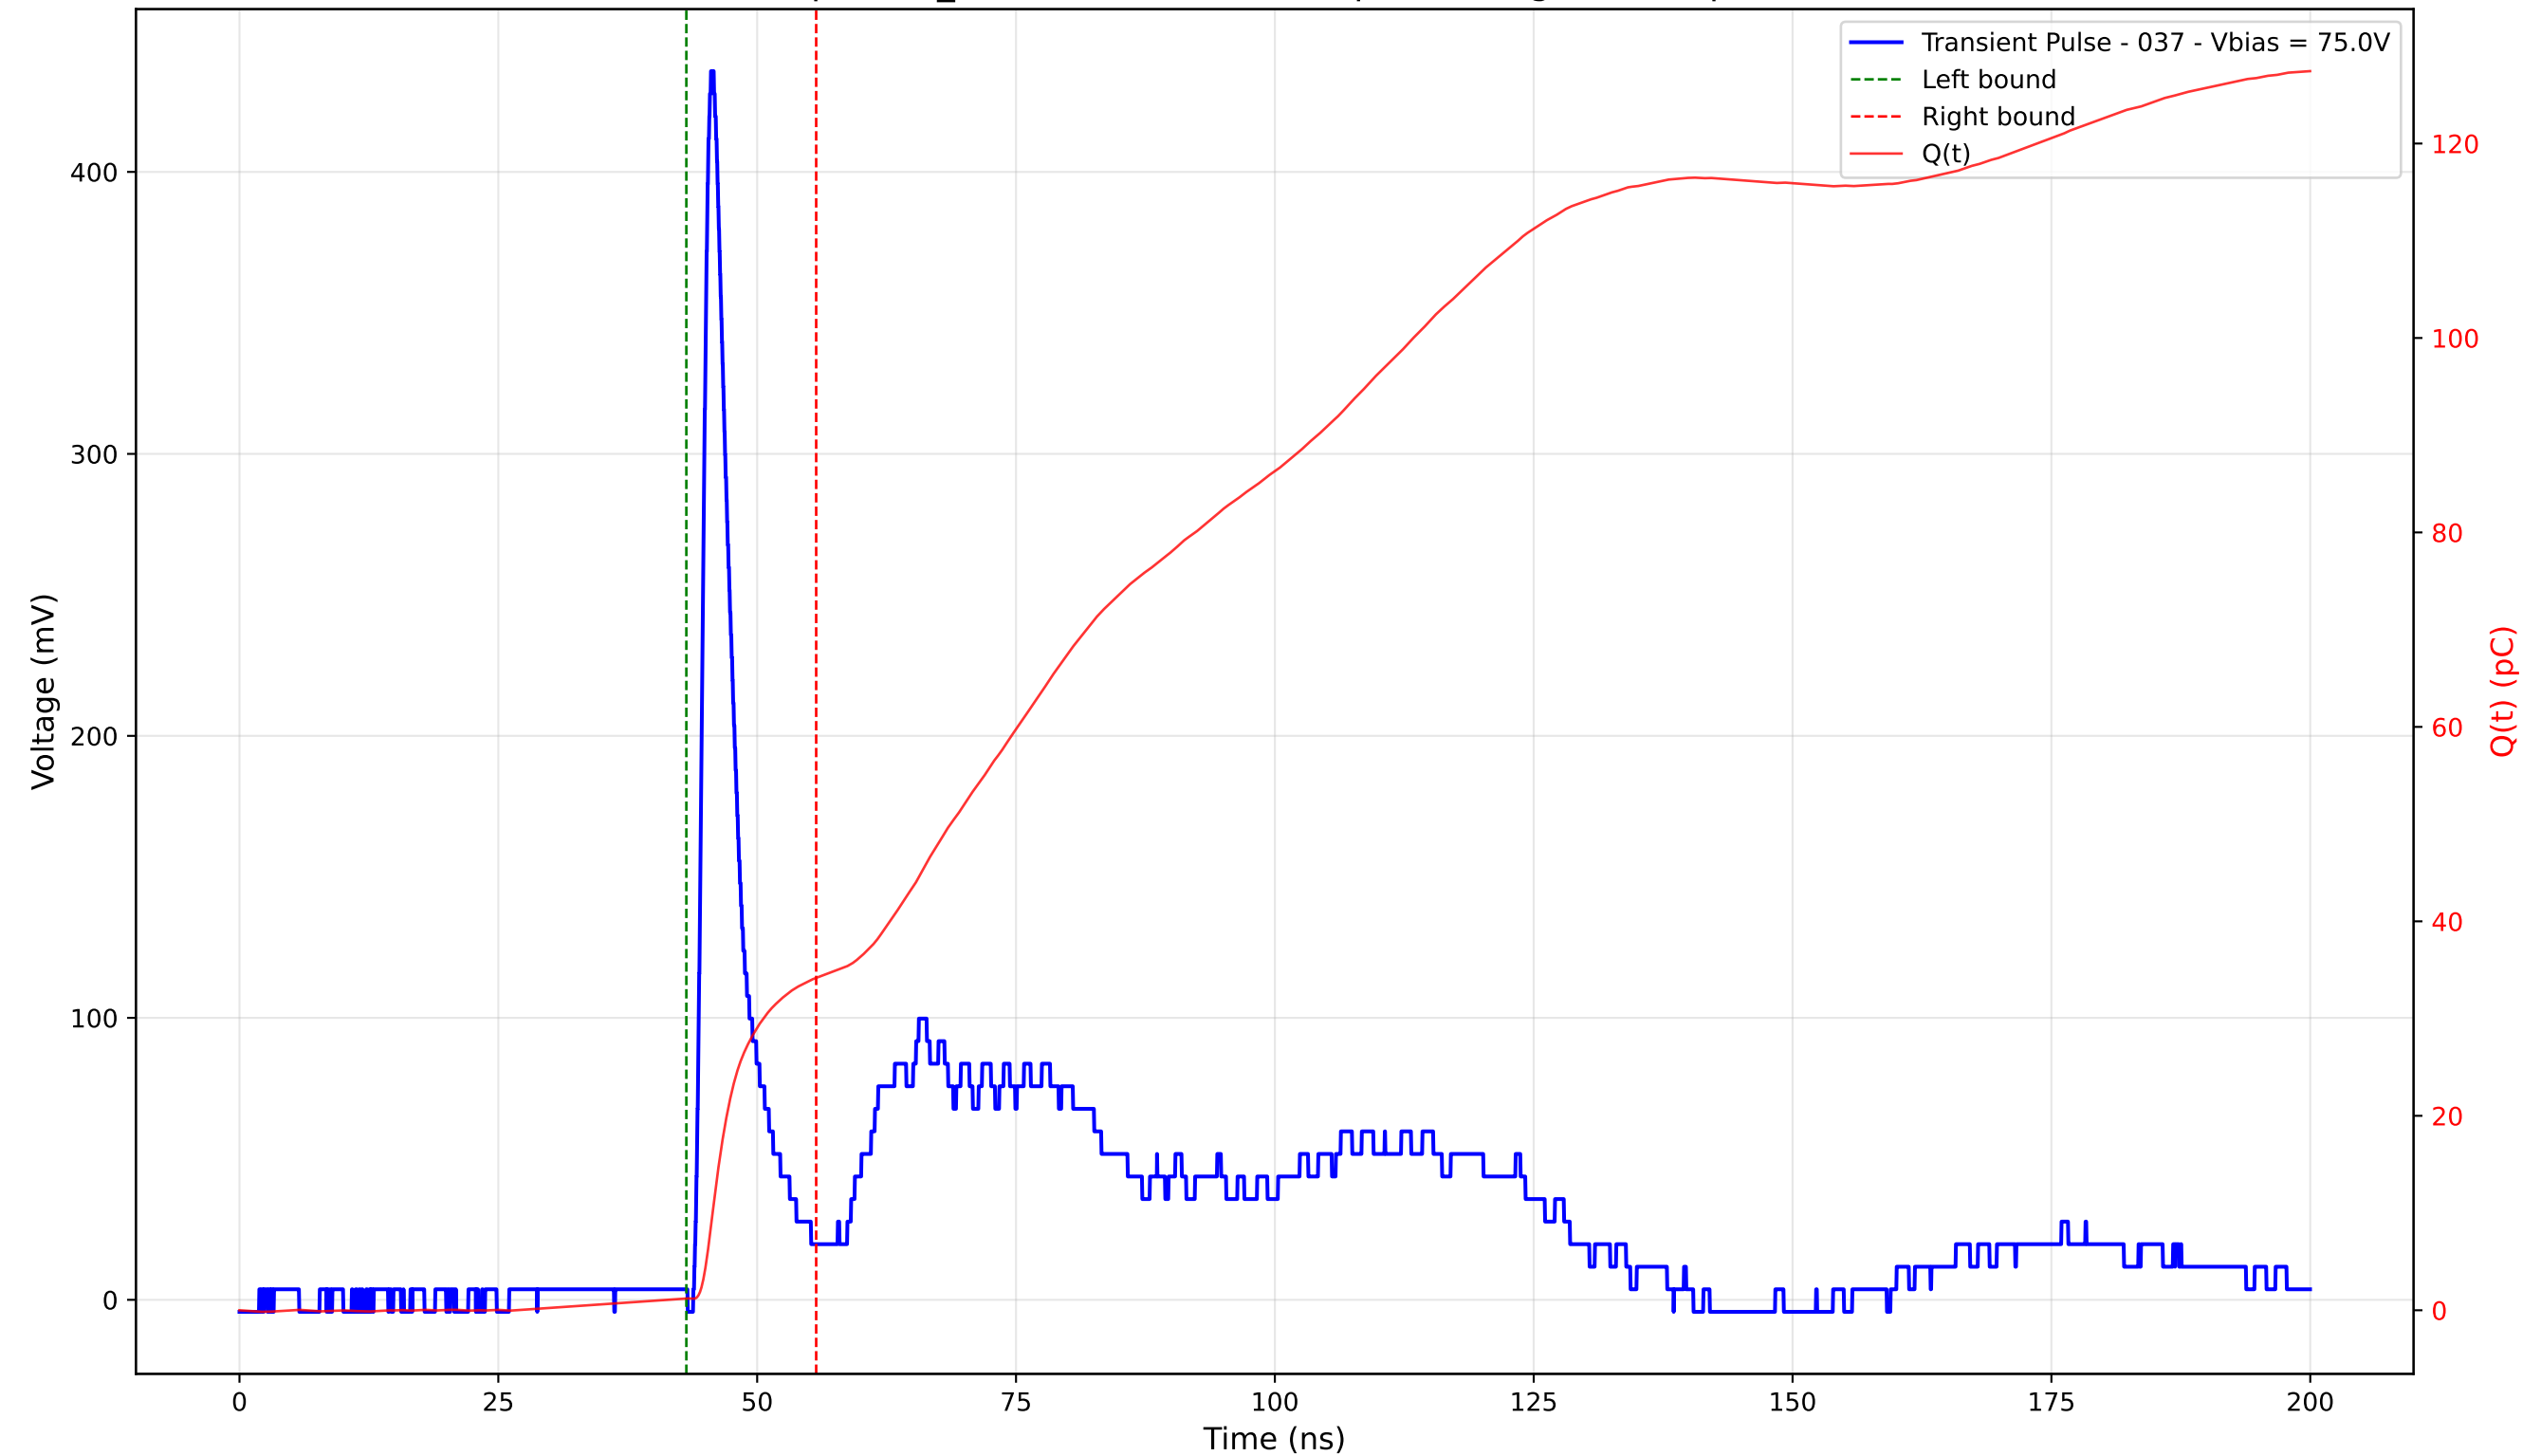


Transient Pulse - Sample: TD_4004 - Position: 150.0 μm - Charge: 33.45 pC - Rise Time: 1.06 ns

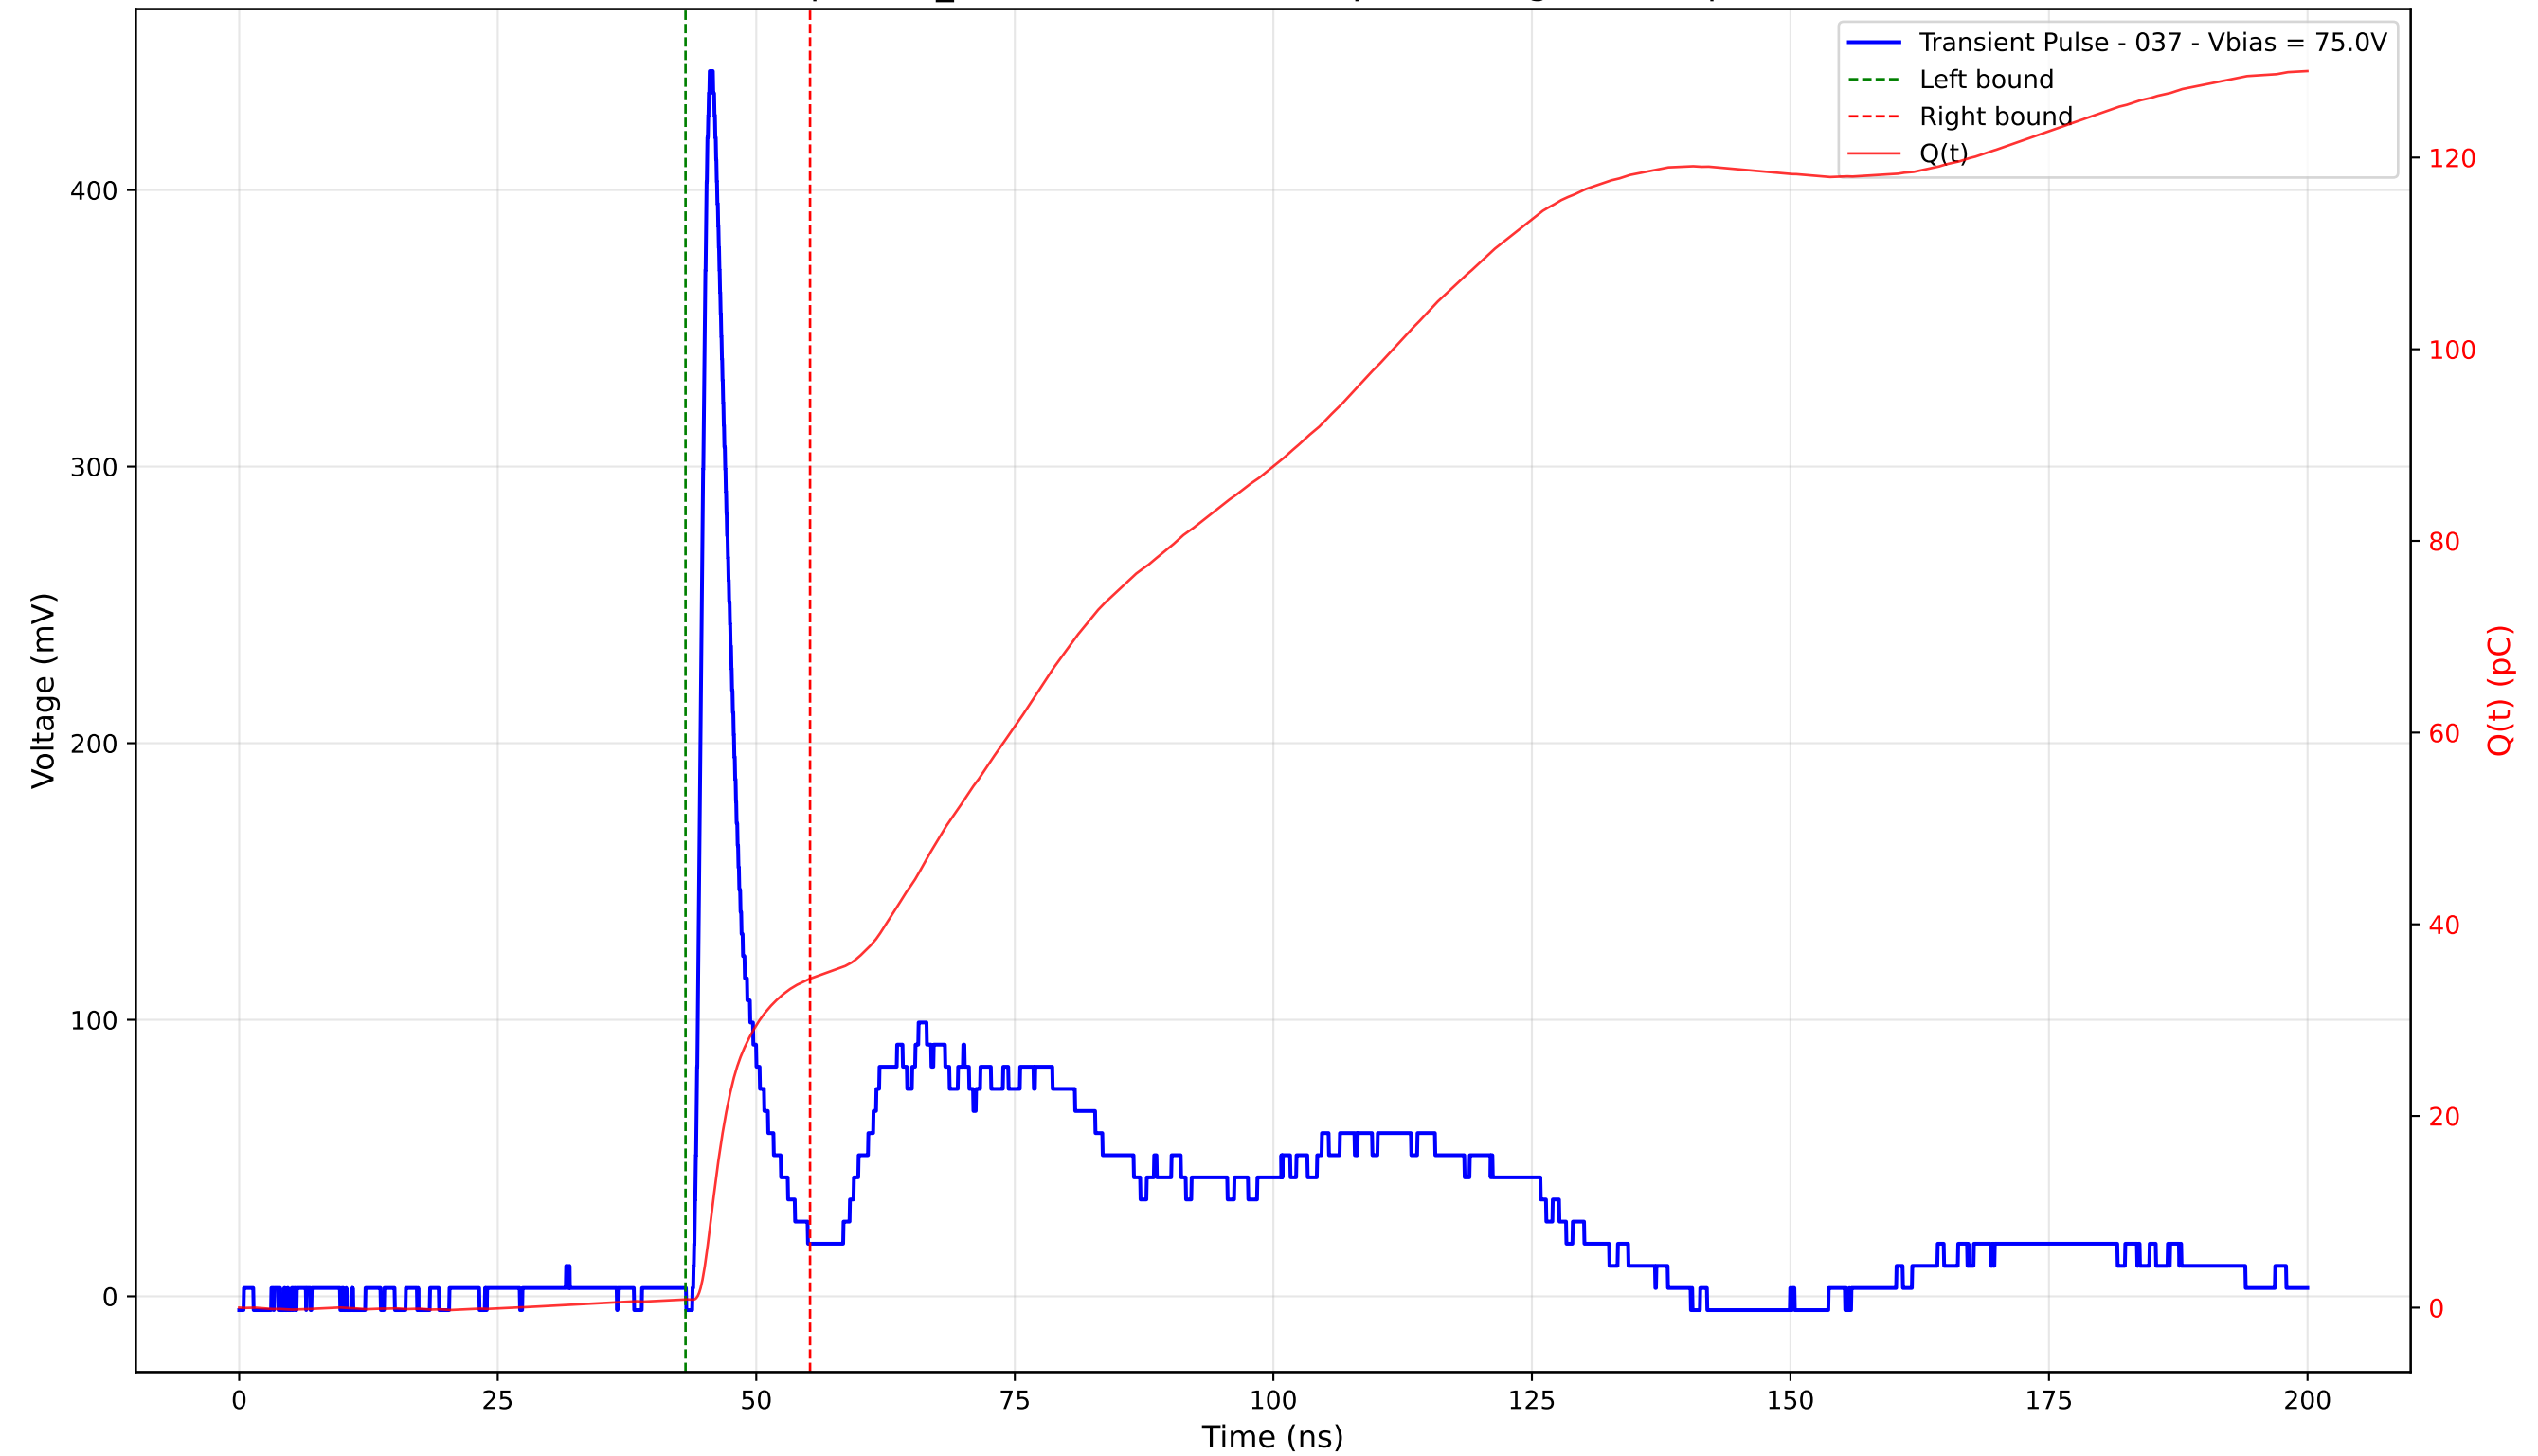


Transient Pulse - Sample: TD_4004 - Position: 155.0 μm - Charge: 33.89 pC - Rise Time: 1.07 ns

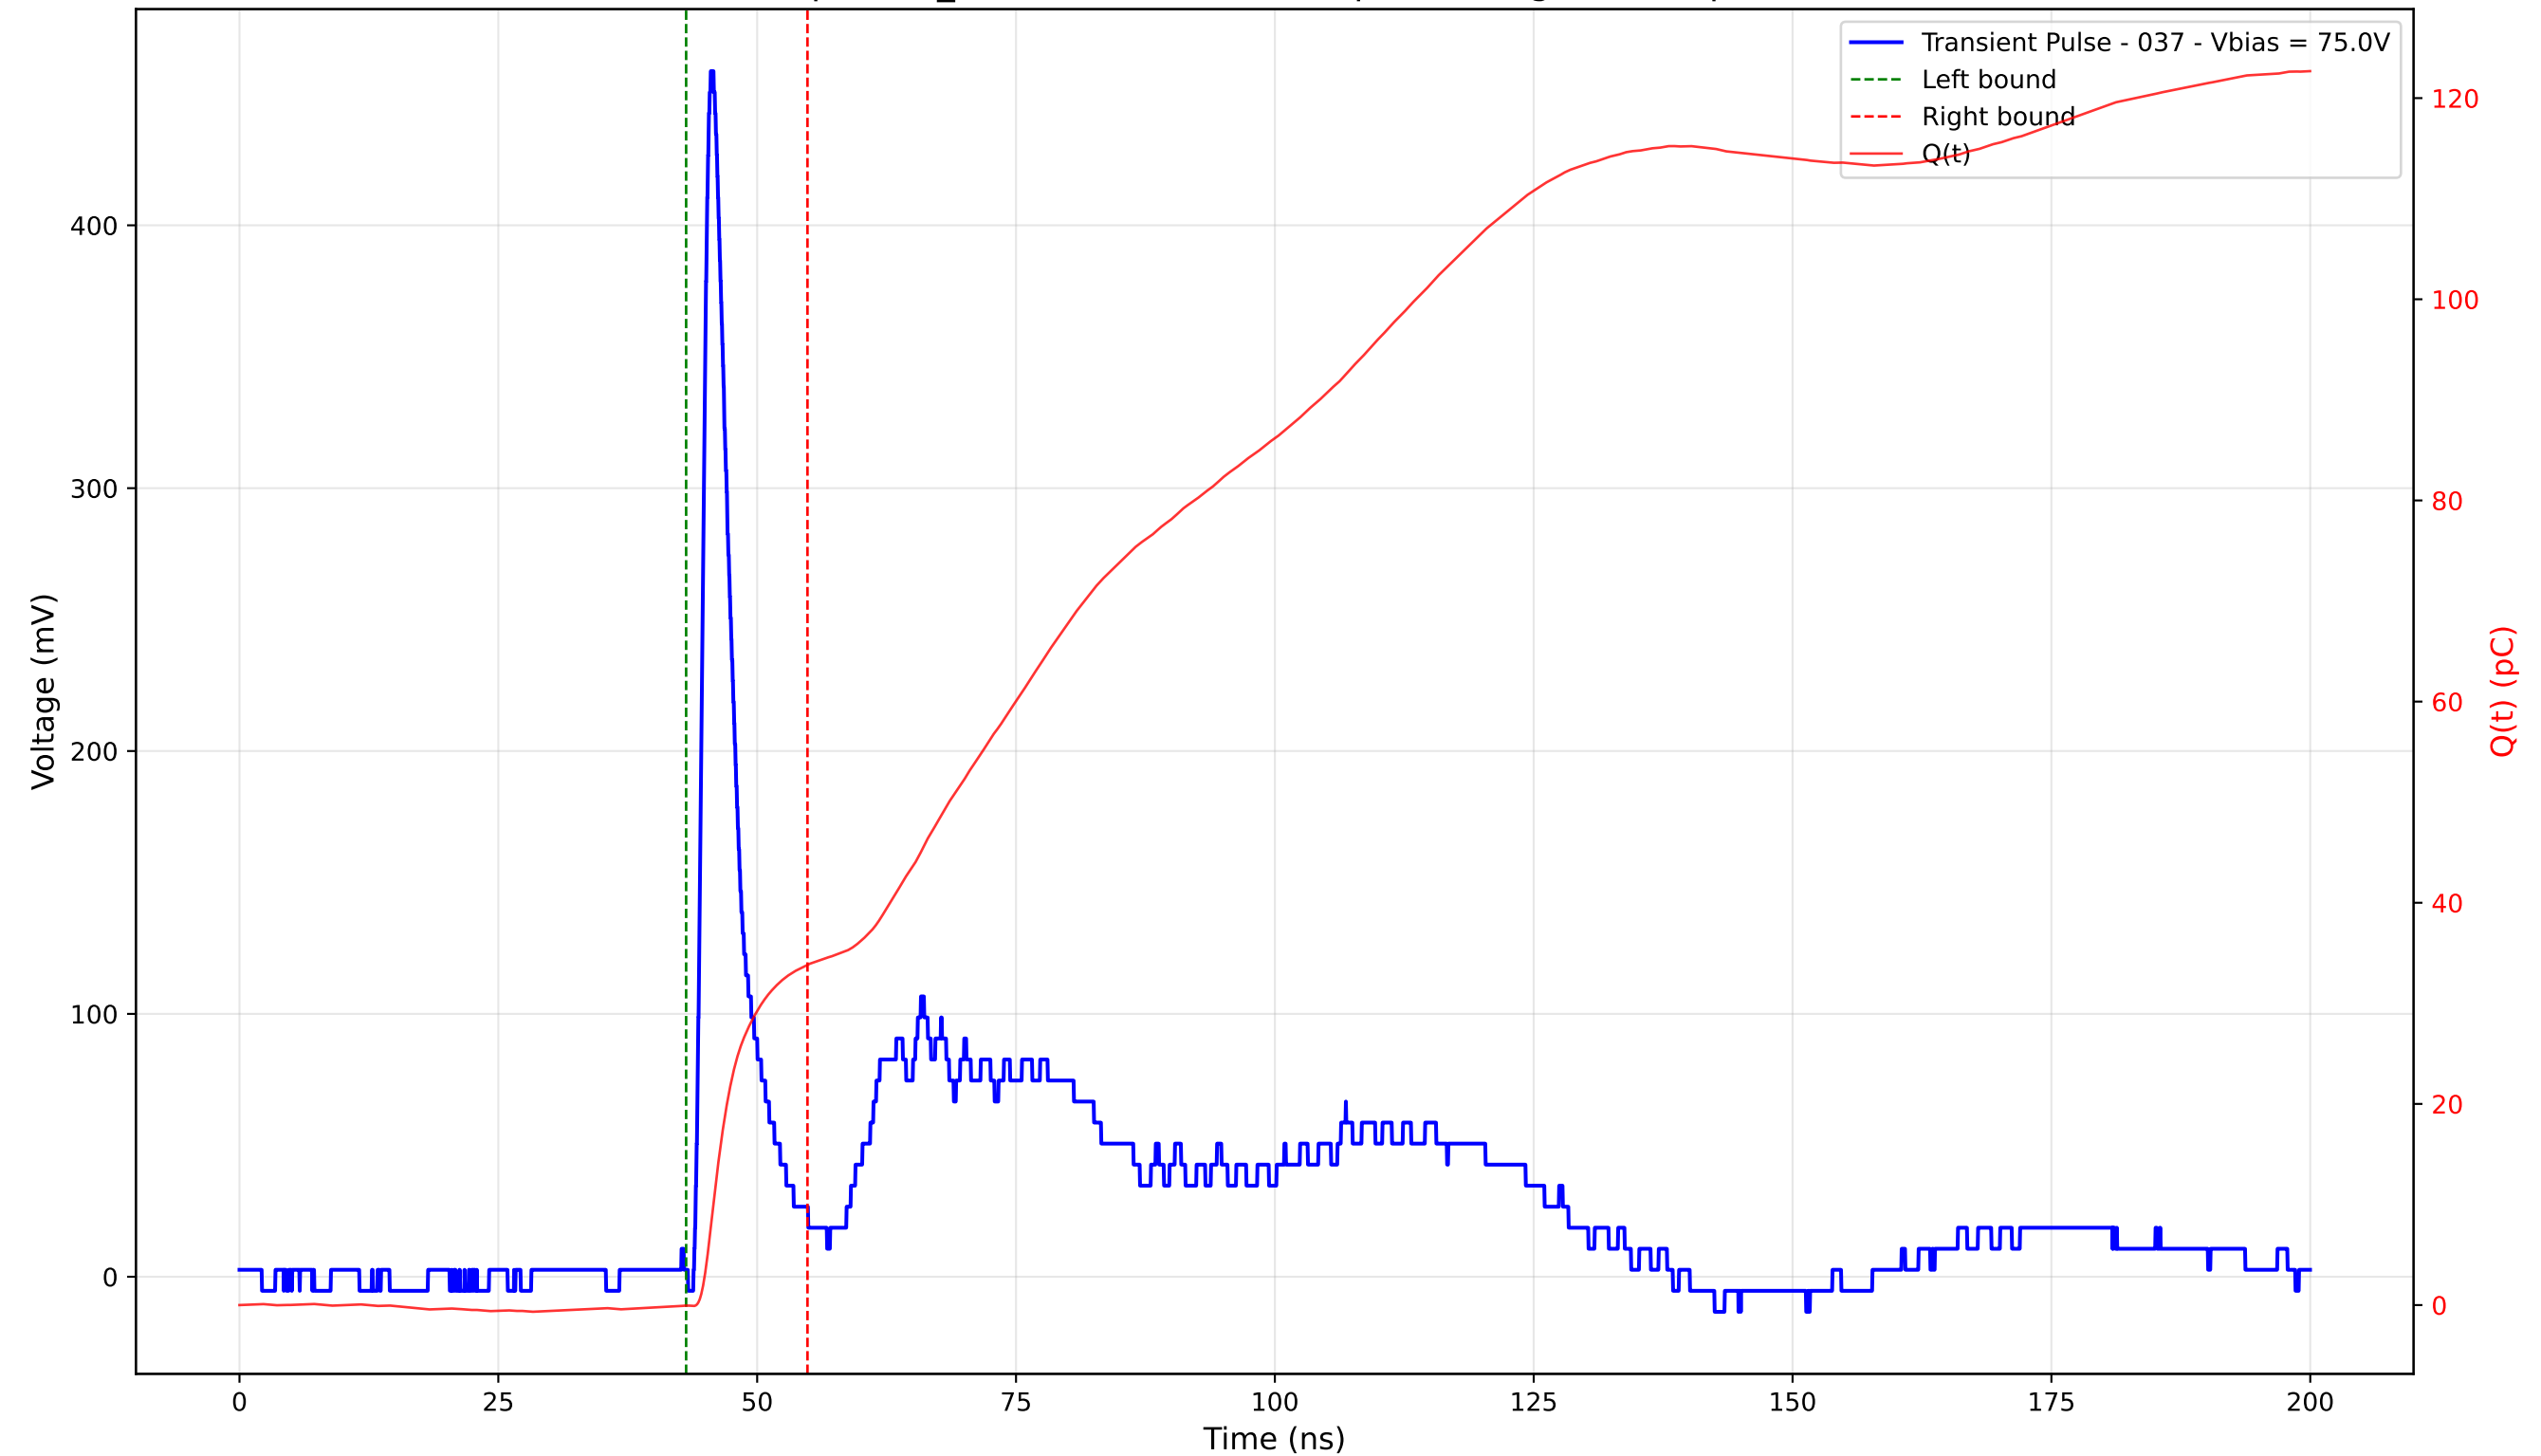


Transient Pulse - Sample: TD_4004 - Position: 160.0 μm - Charge: 35.88 pC - Rise Time: 1.07 ns

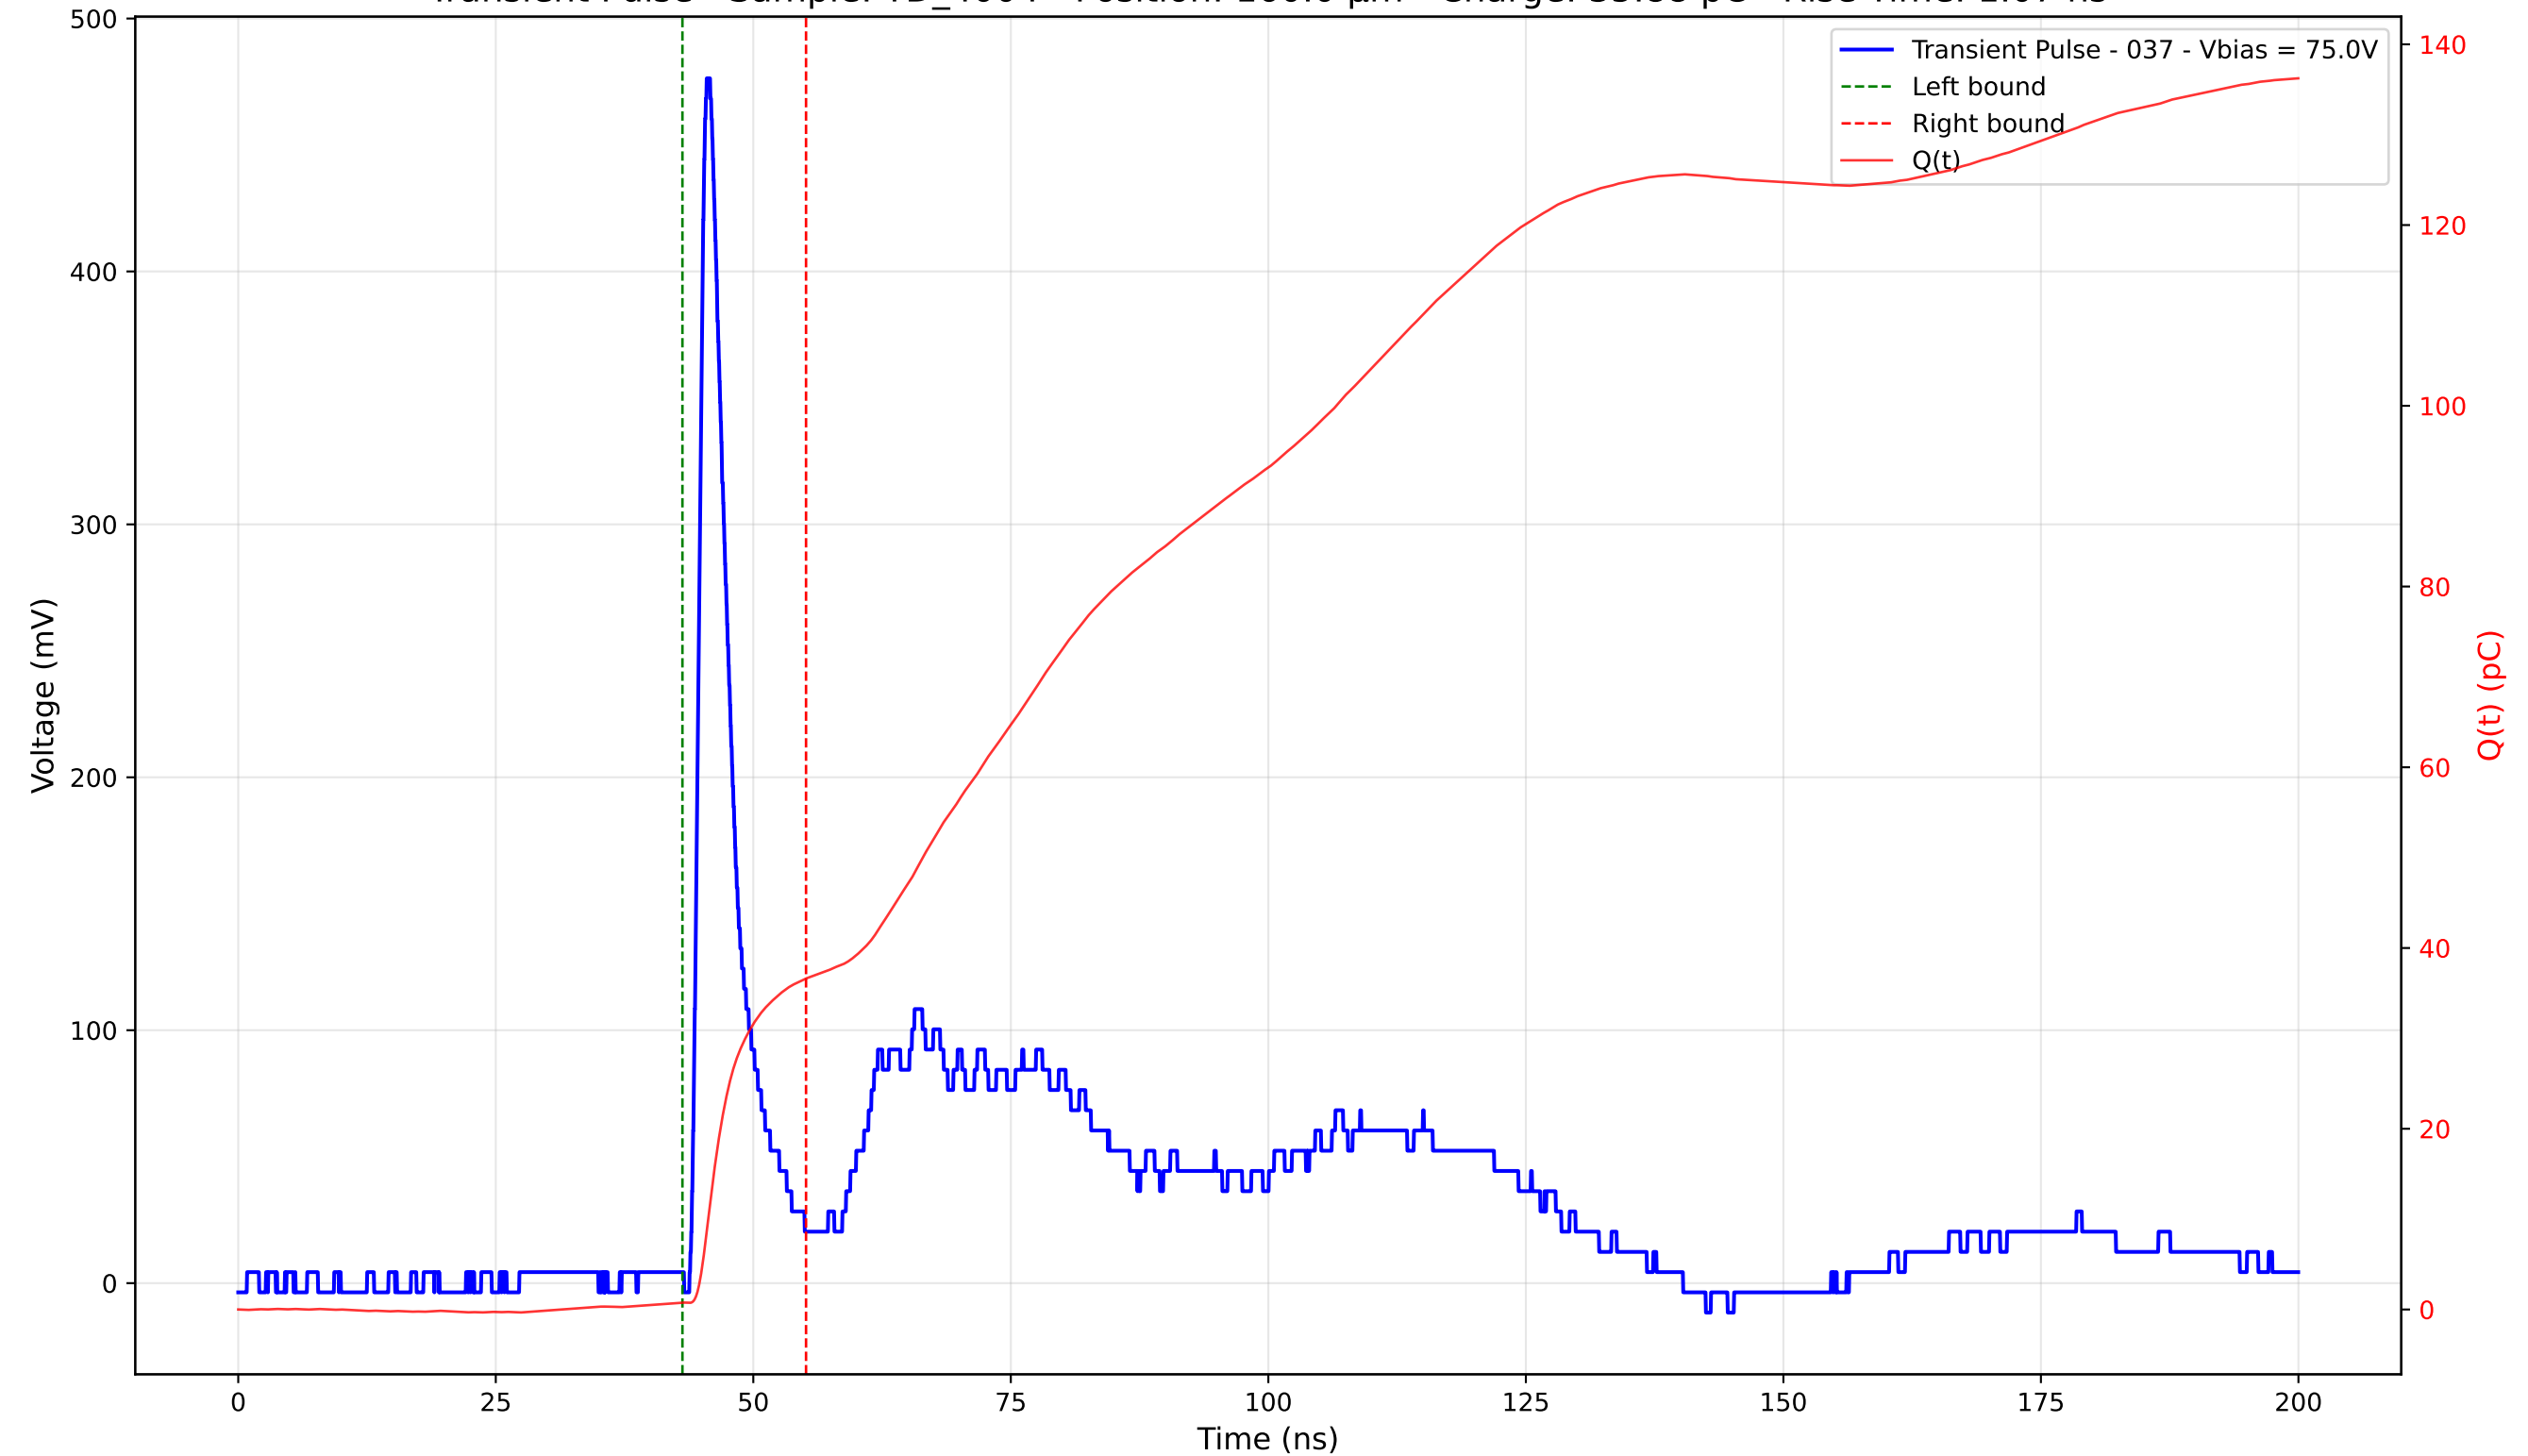


Transient Pulse - Sample: TD_4004 - Position: 165.0 μm - Charge: 37.26 pC - Rise Time: 1.06 ns

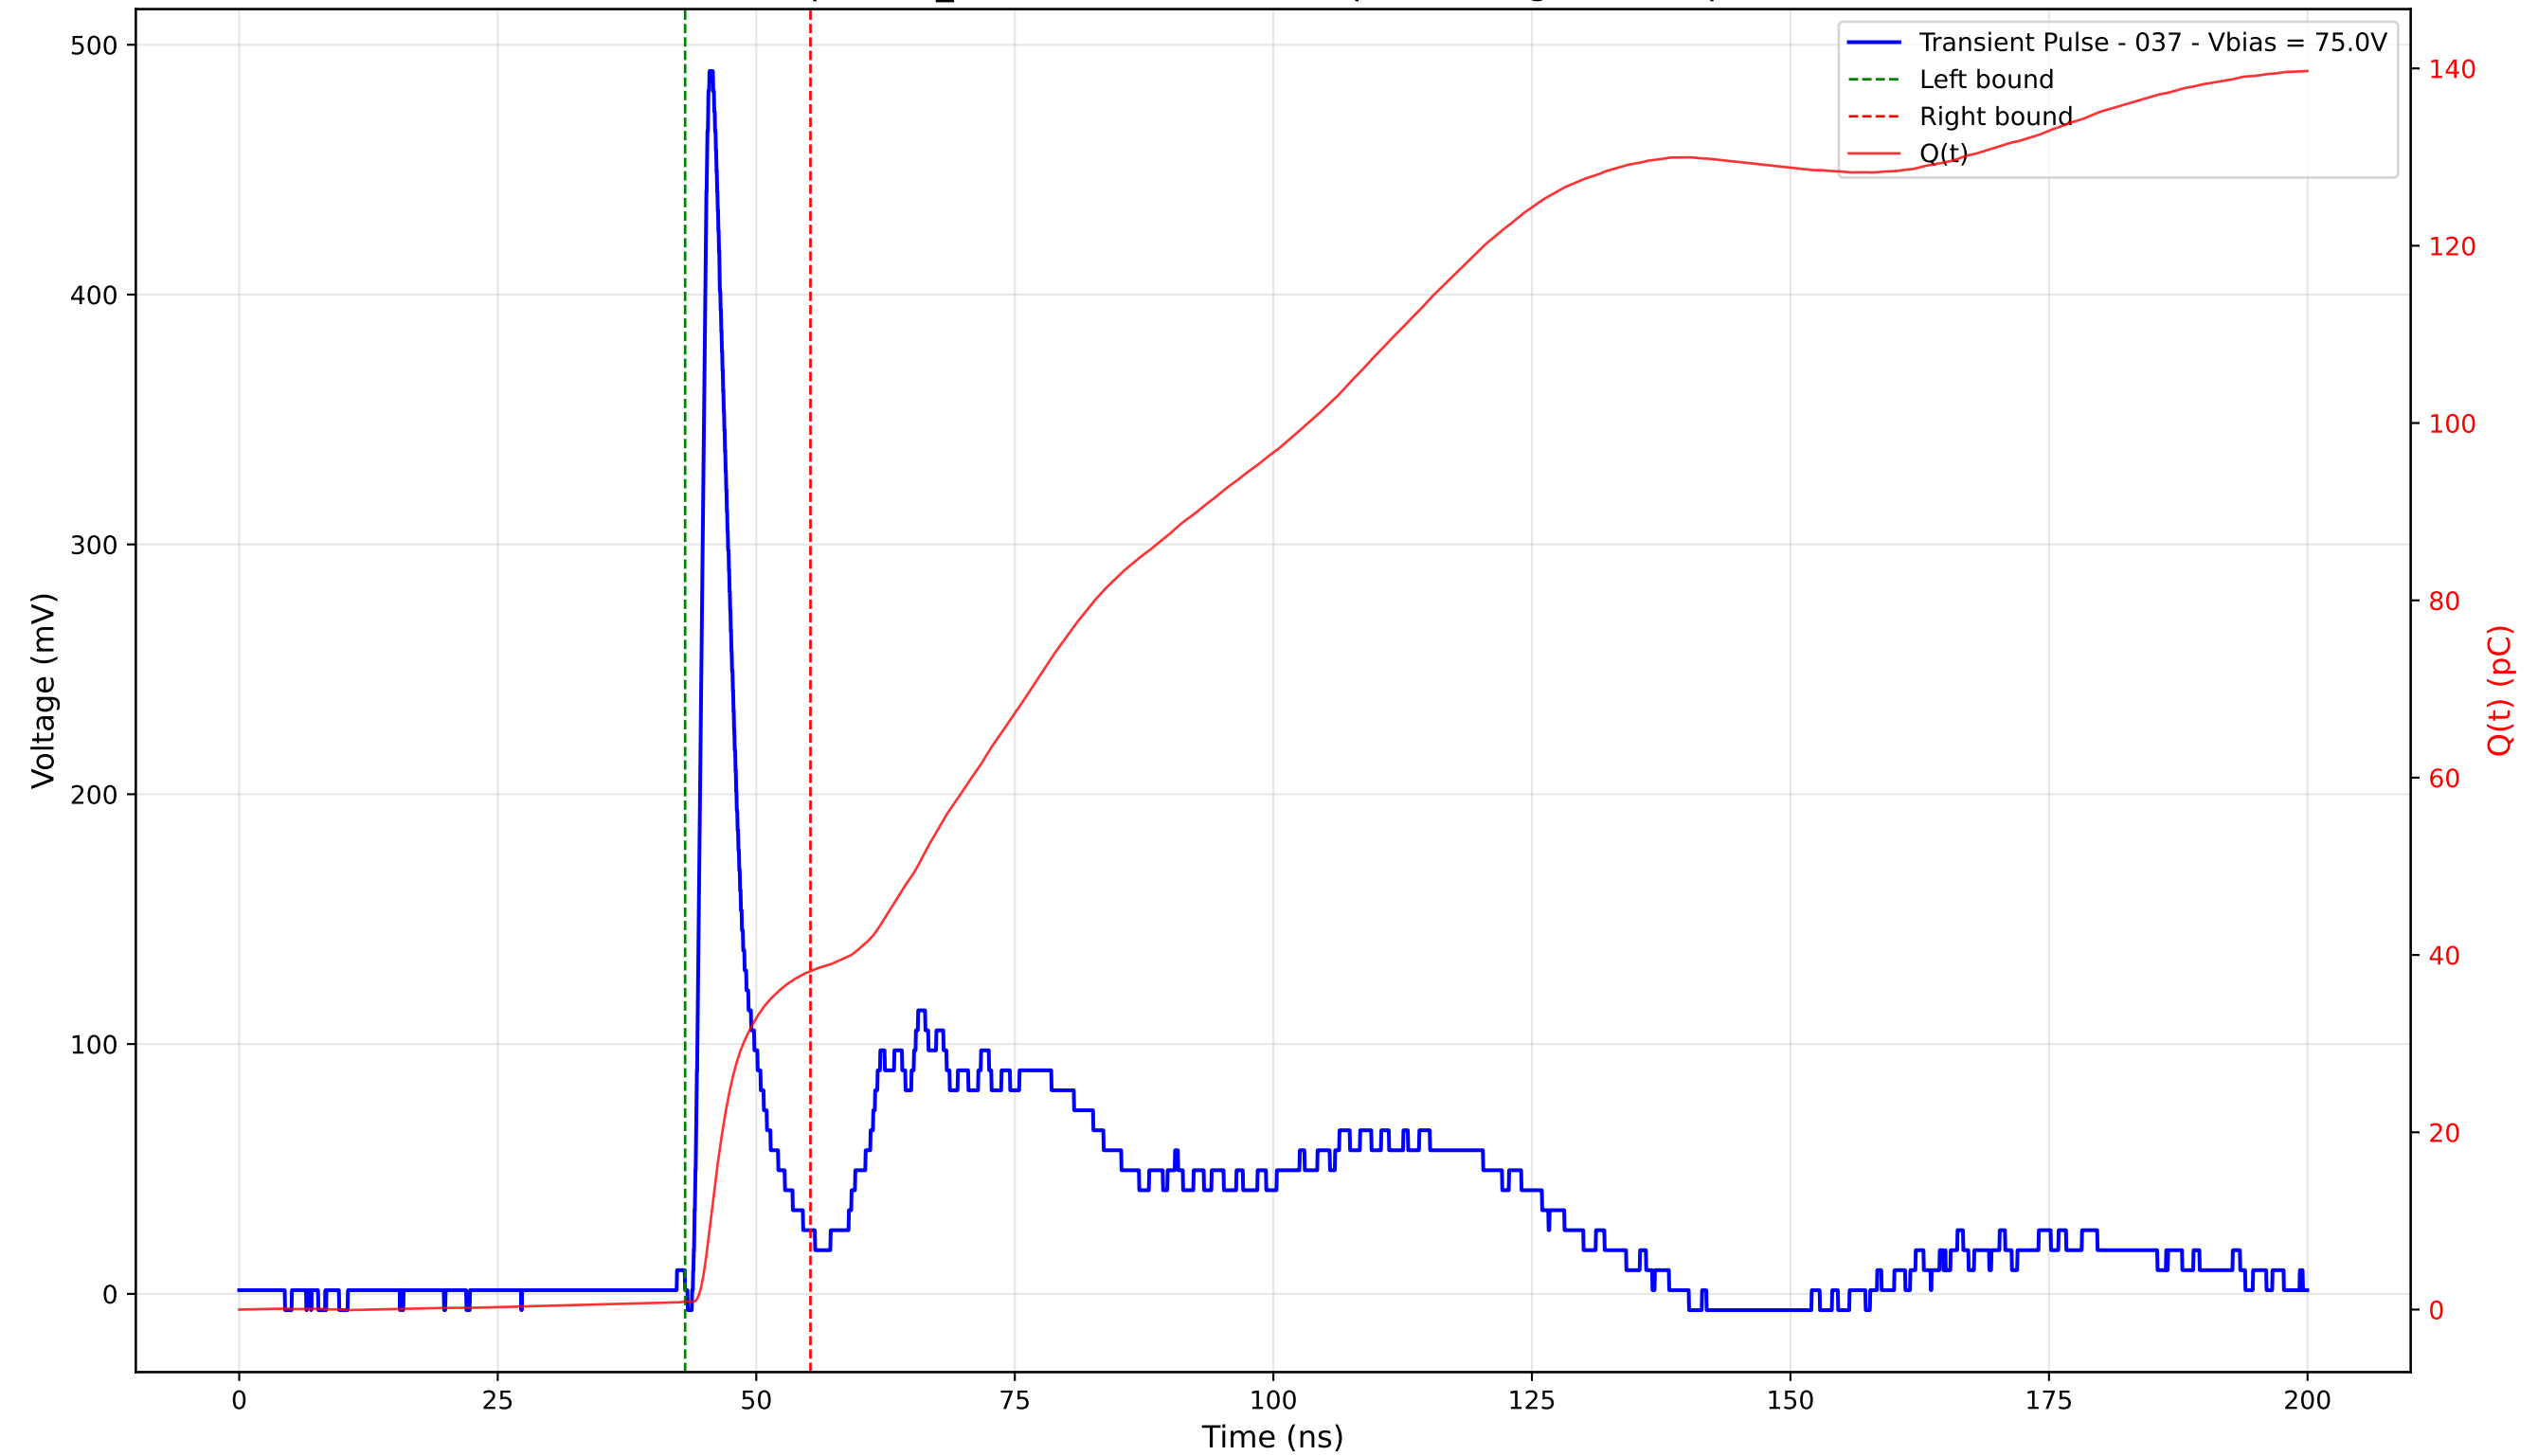


Transient Pulse - Sample: TD_4004 - Position: 170.0 μm - Charge: 41.02 pC - Rise Time: 1.08 ns

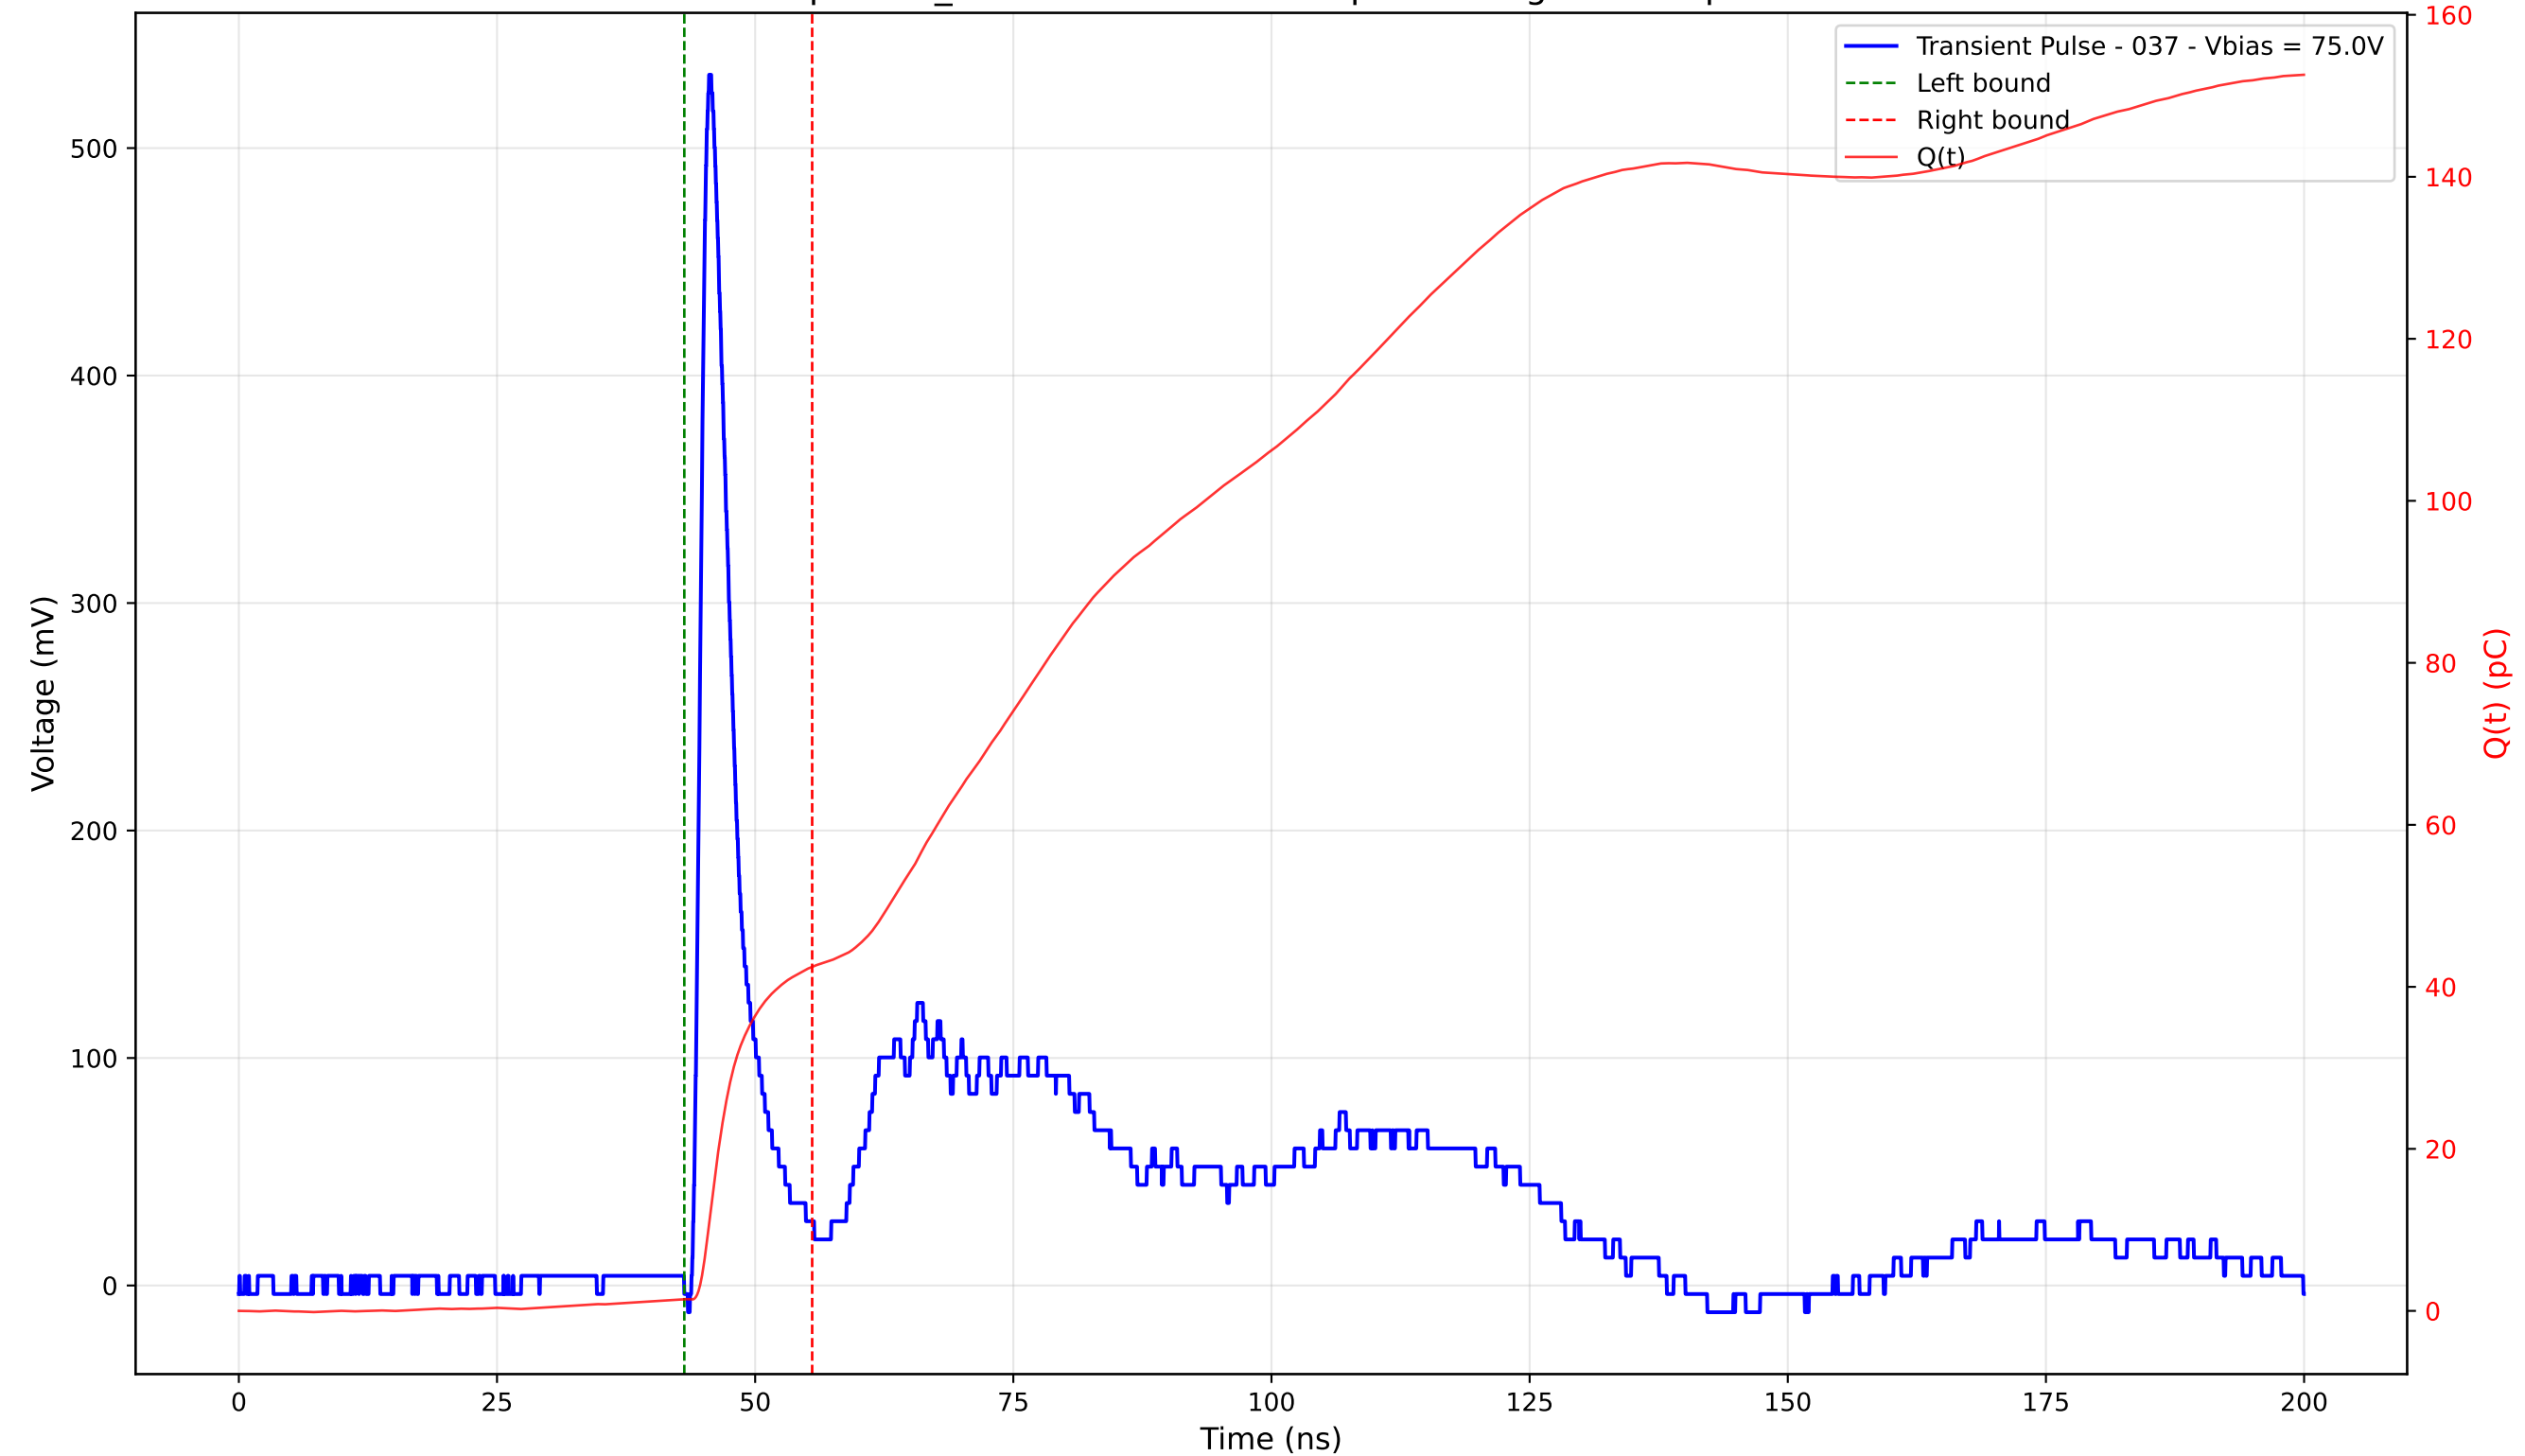


Transient Pulse - Sample: TD_4004 - Position: 175.0 μm - Charge: 43.81 pC - Rise Time: 1.05 ns

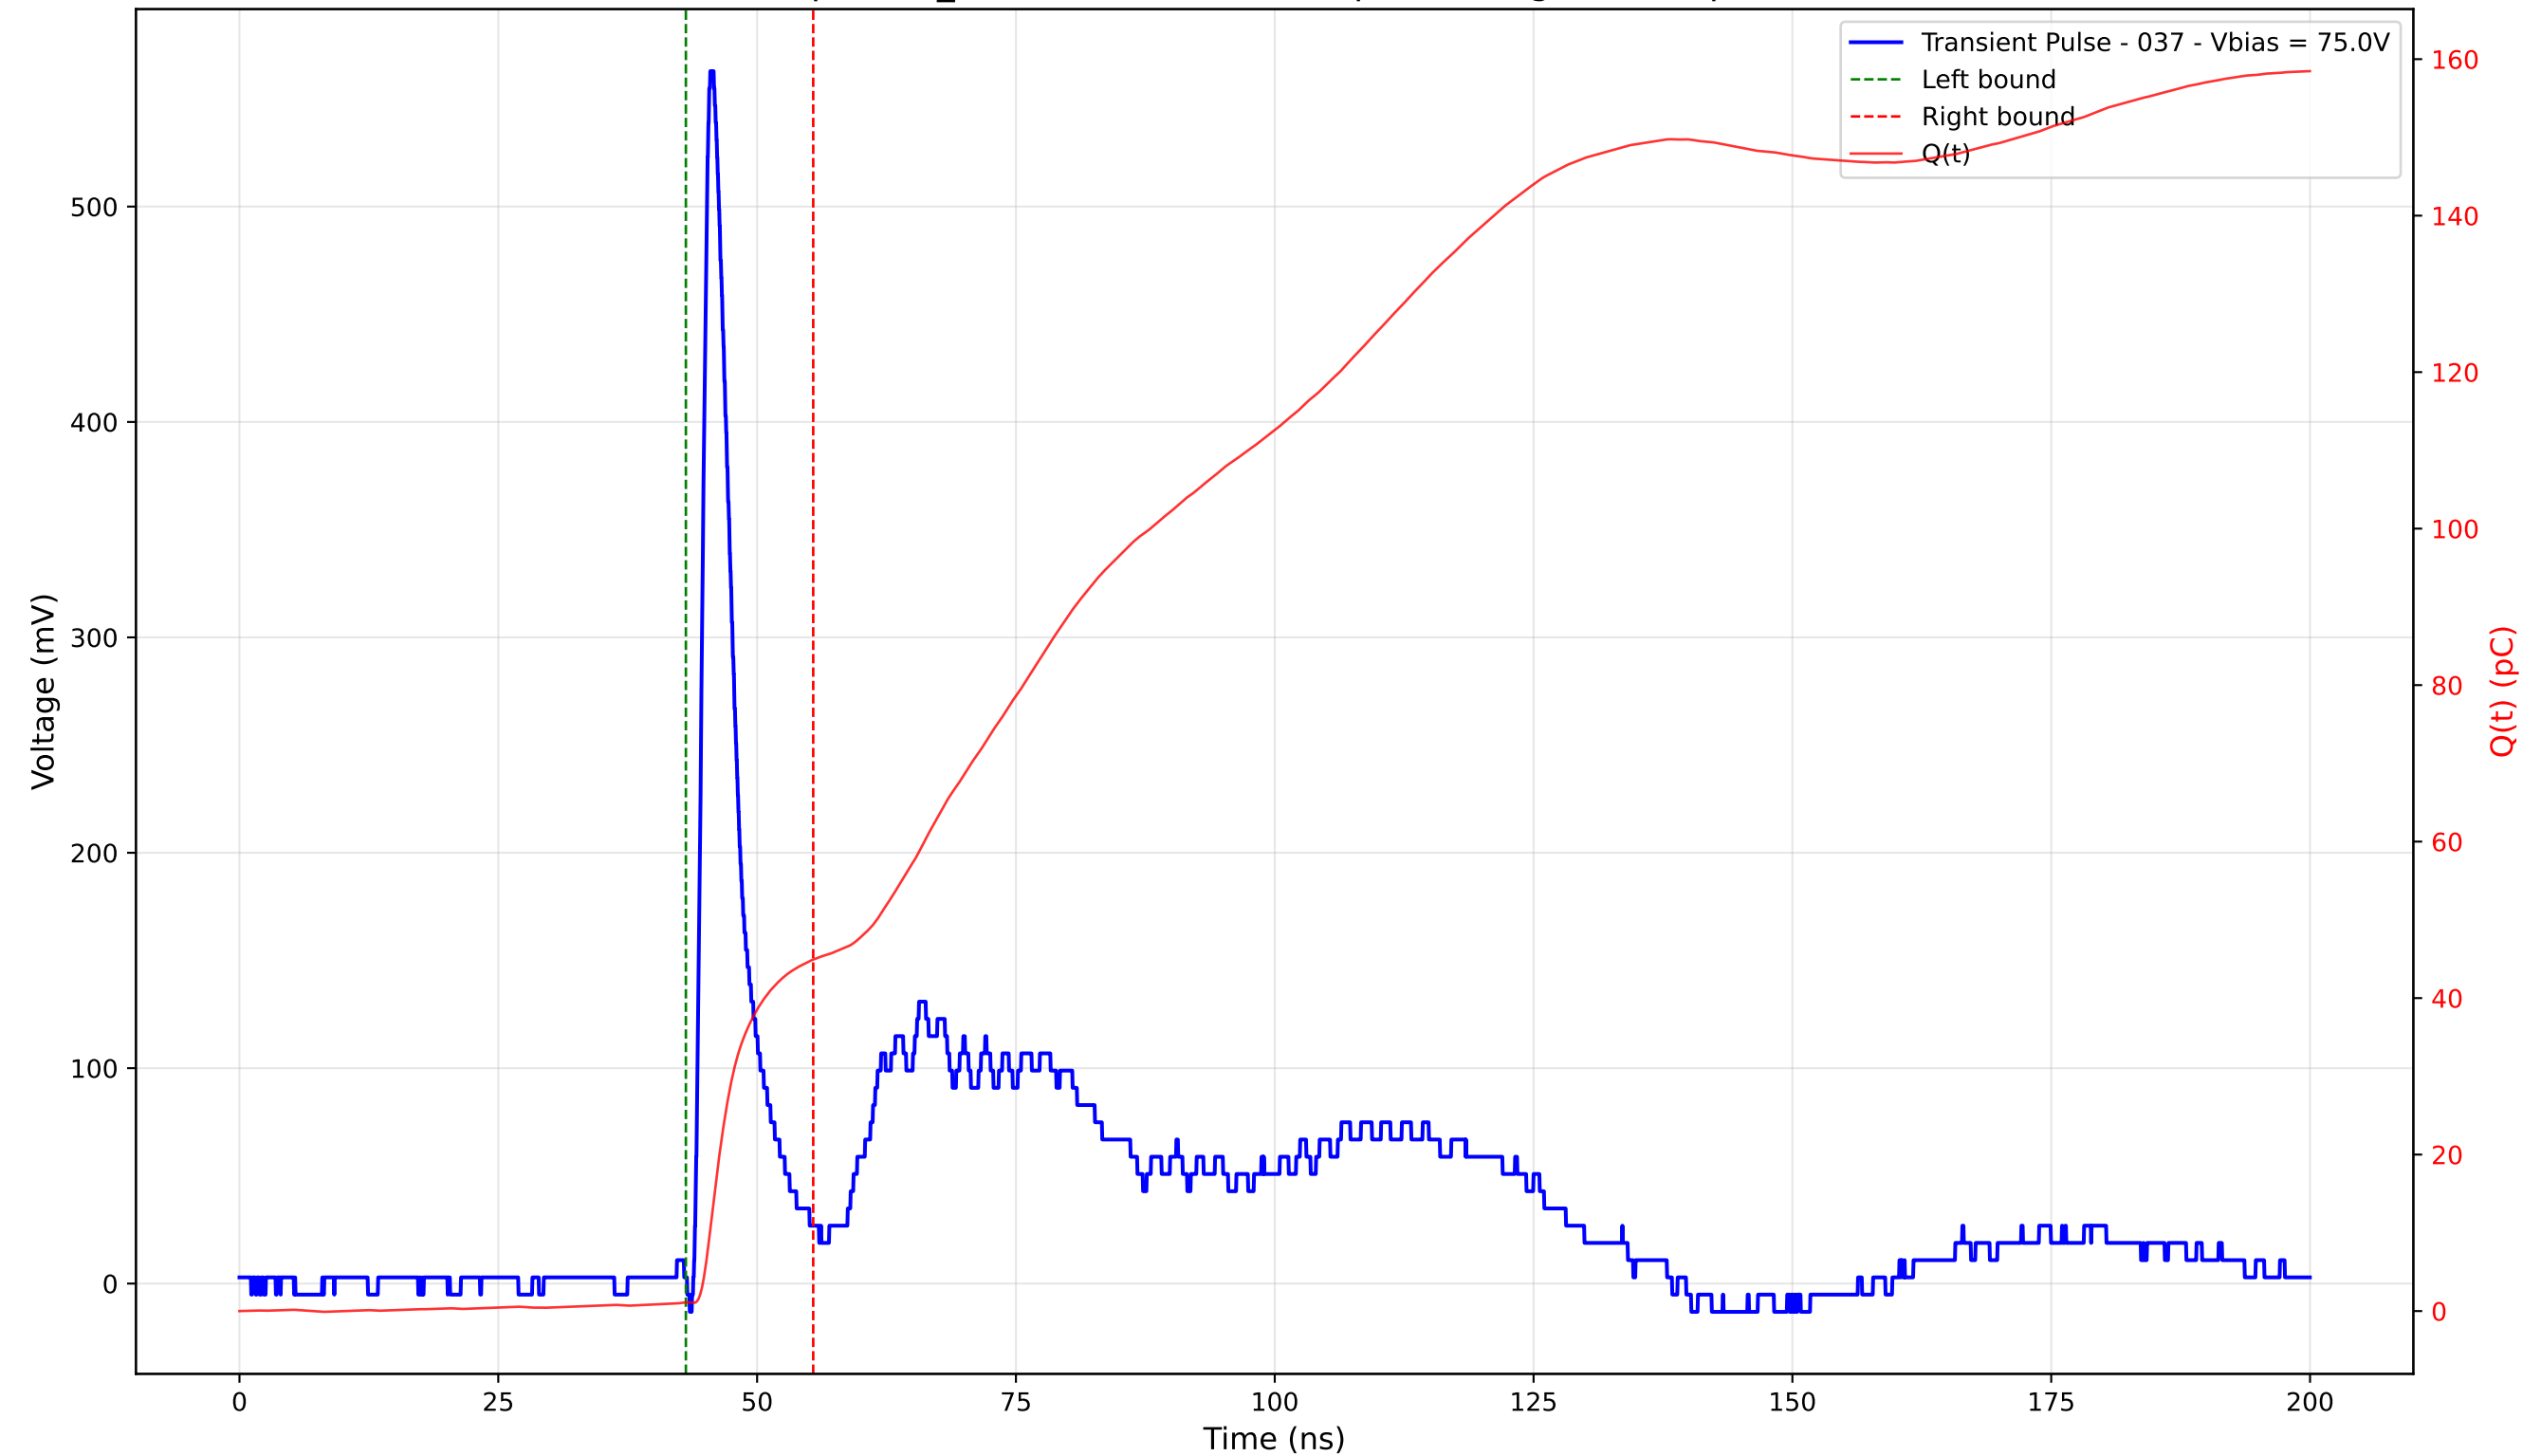


Transient Pulse - Sample: TD_4004 - Position: 180.0 μm - Charge: 45.85 pC - Rise Time: 1.05 ns

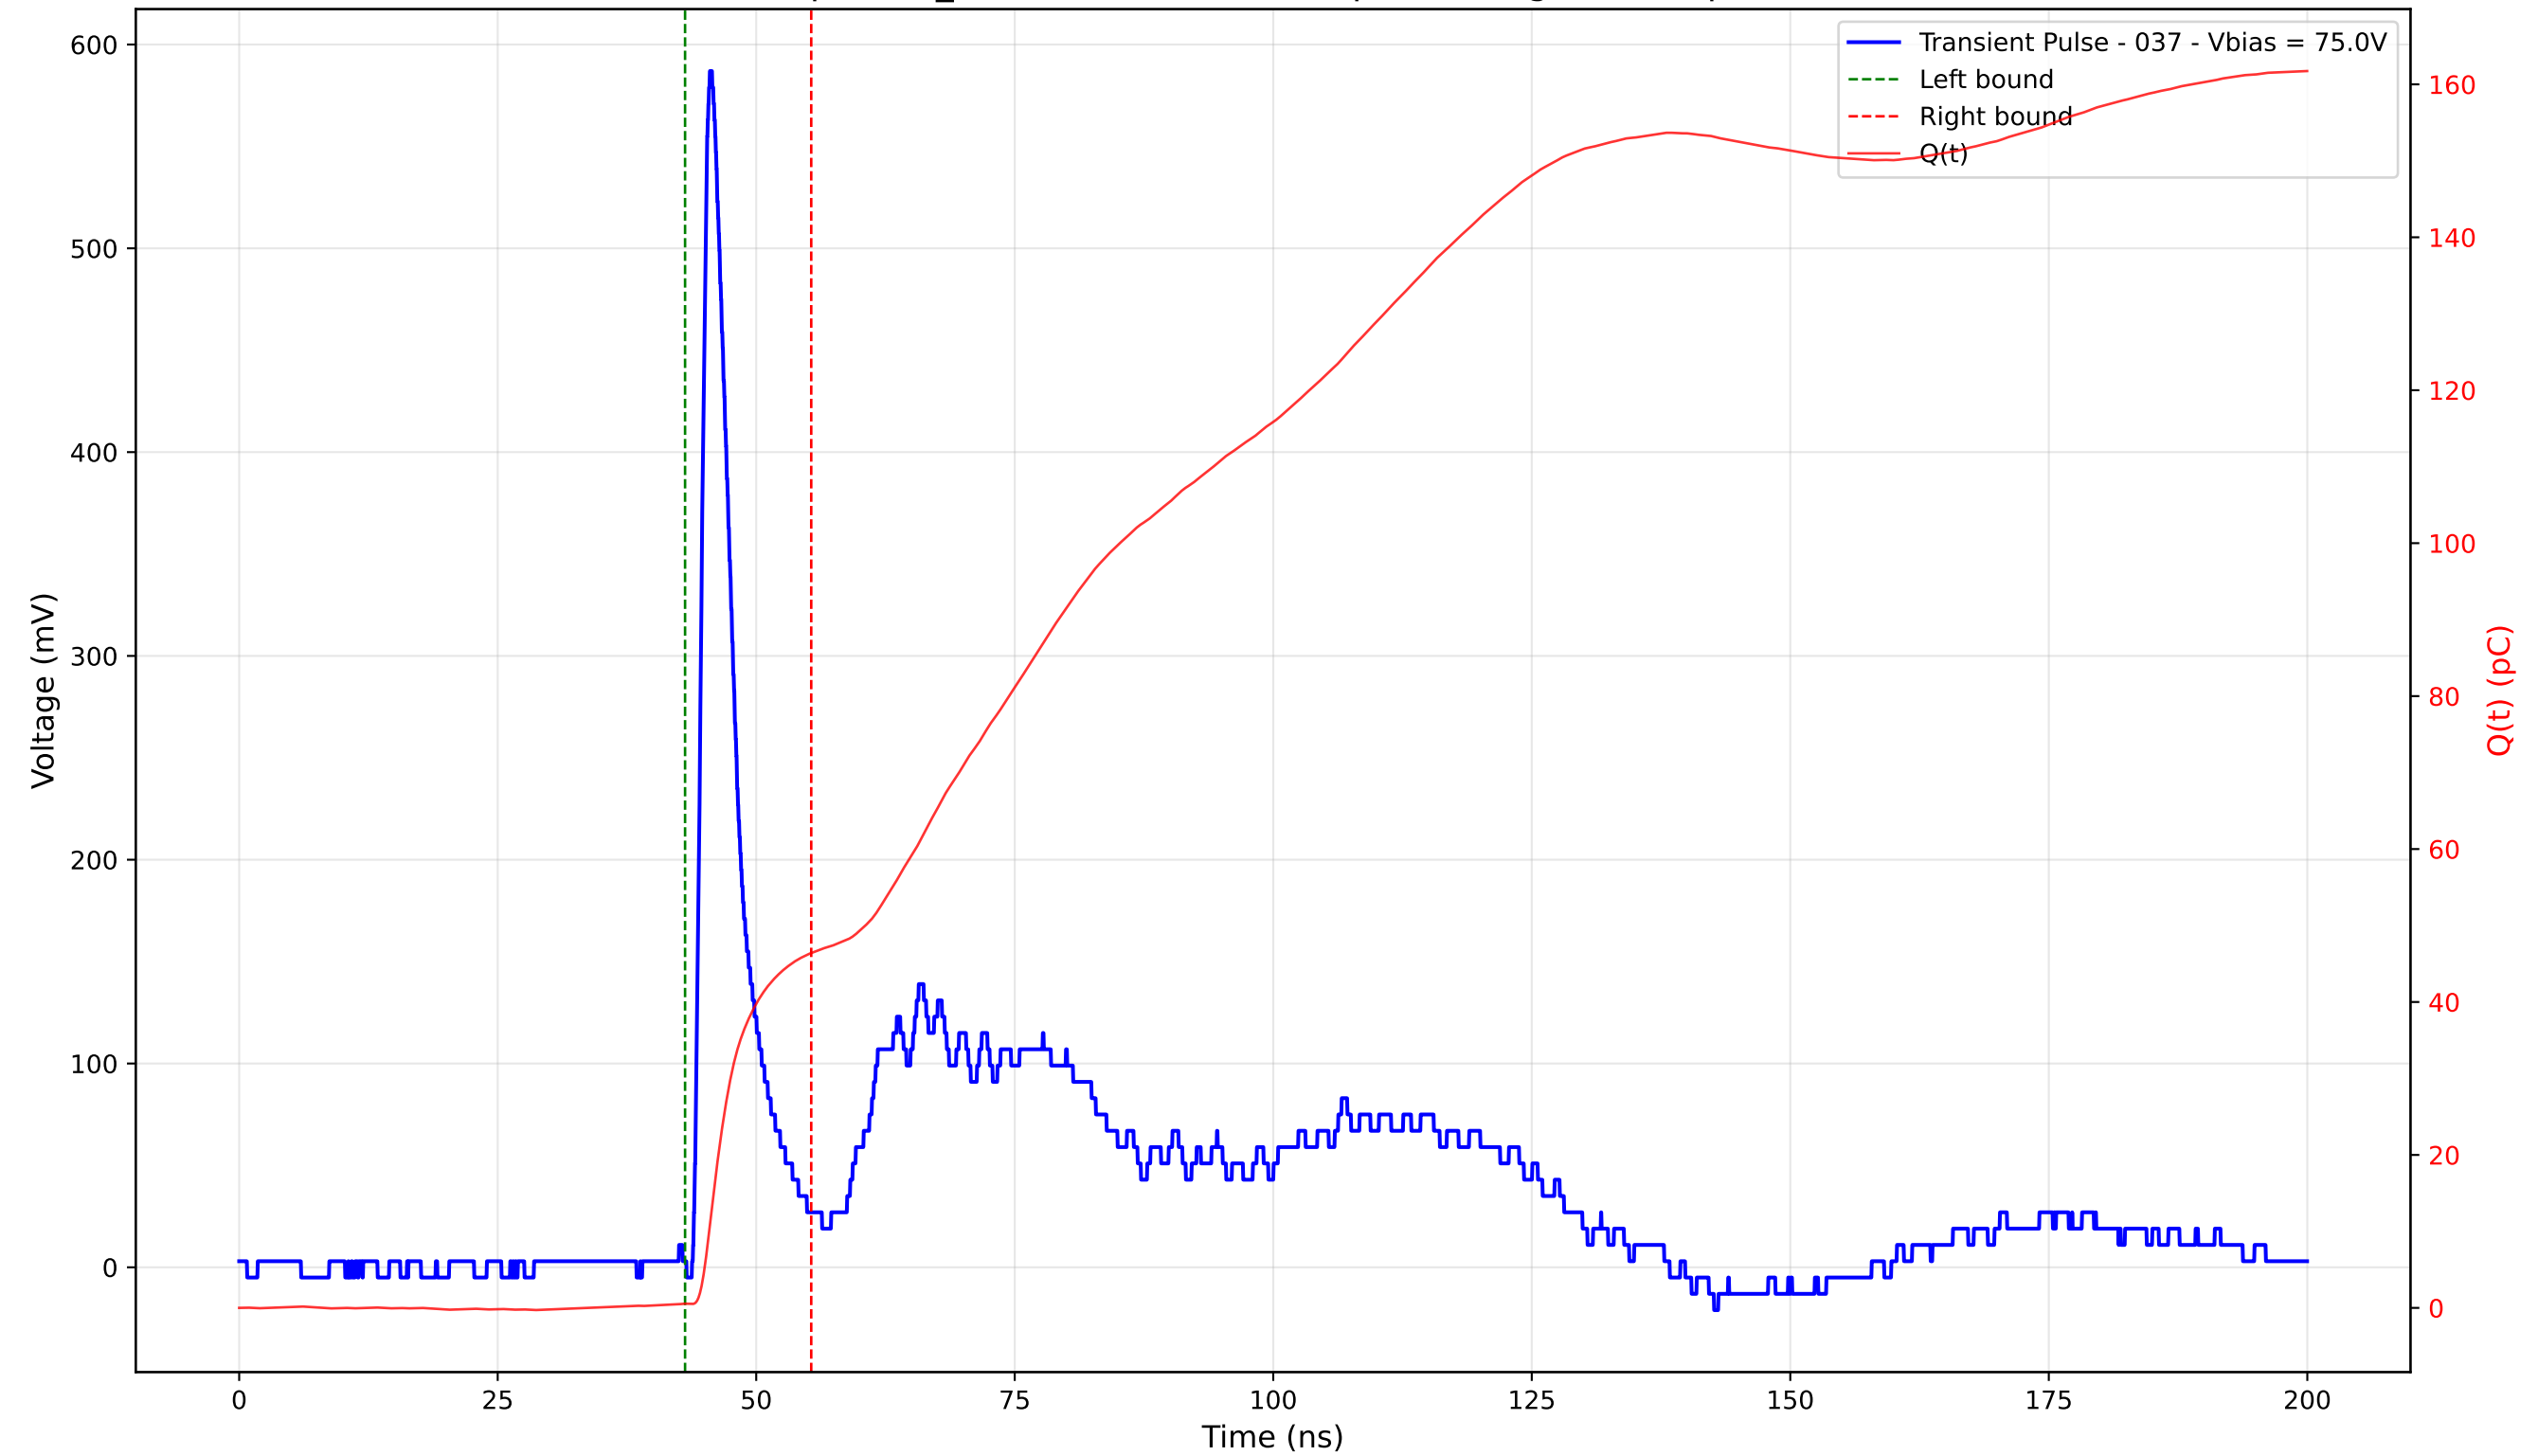


Transient Pulse - Sample: TD_4004 - Position: 185.0 μm - Charge: 47.19 pC - Rise Time: 1.04 ns

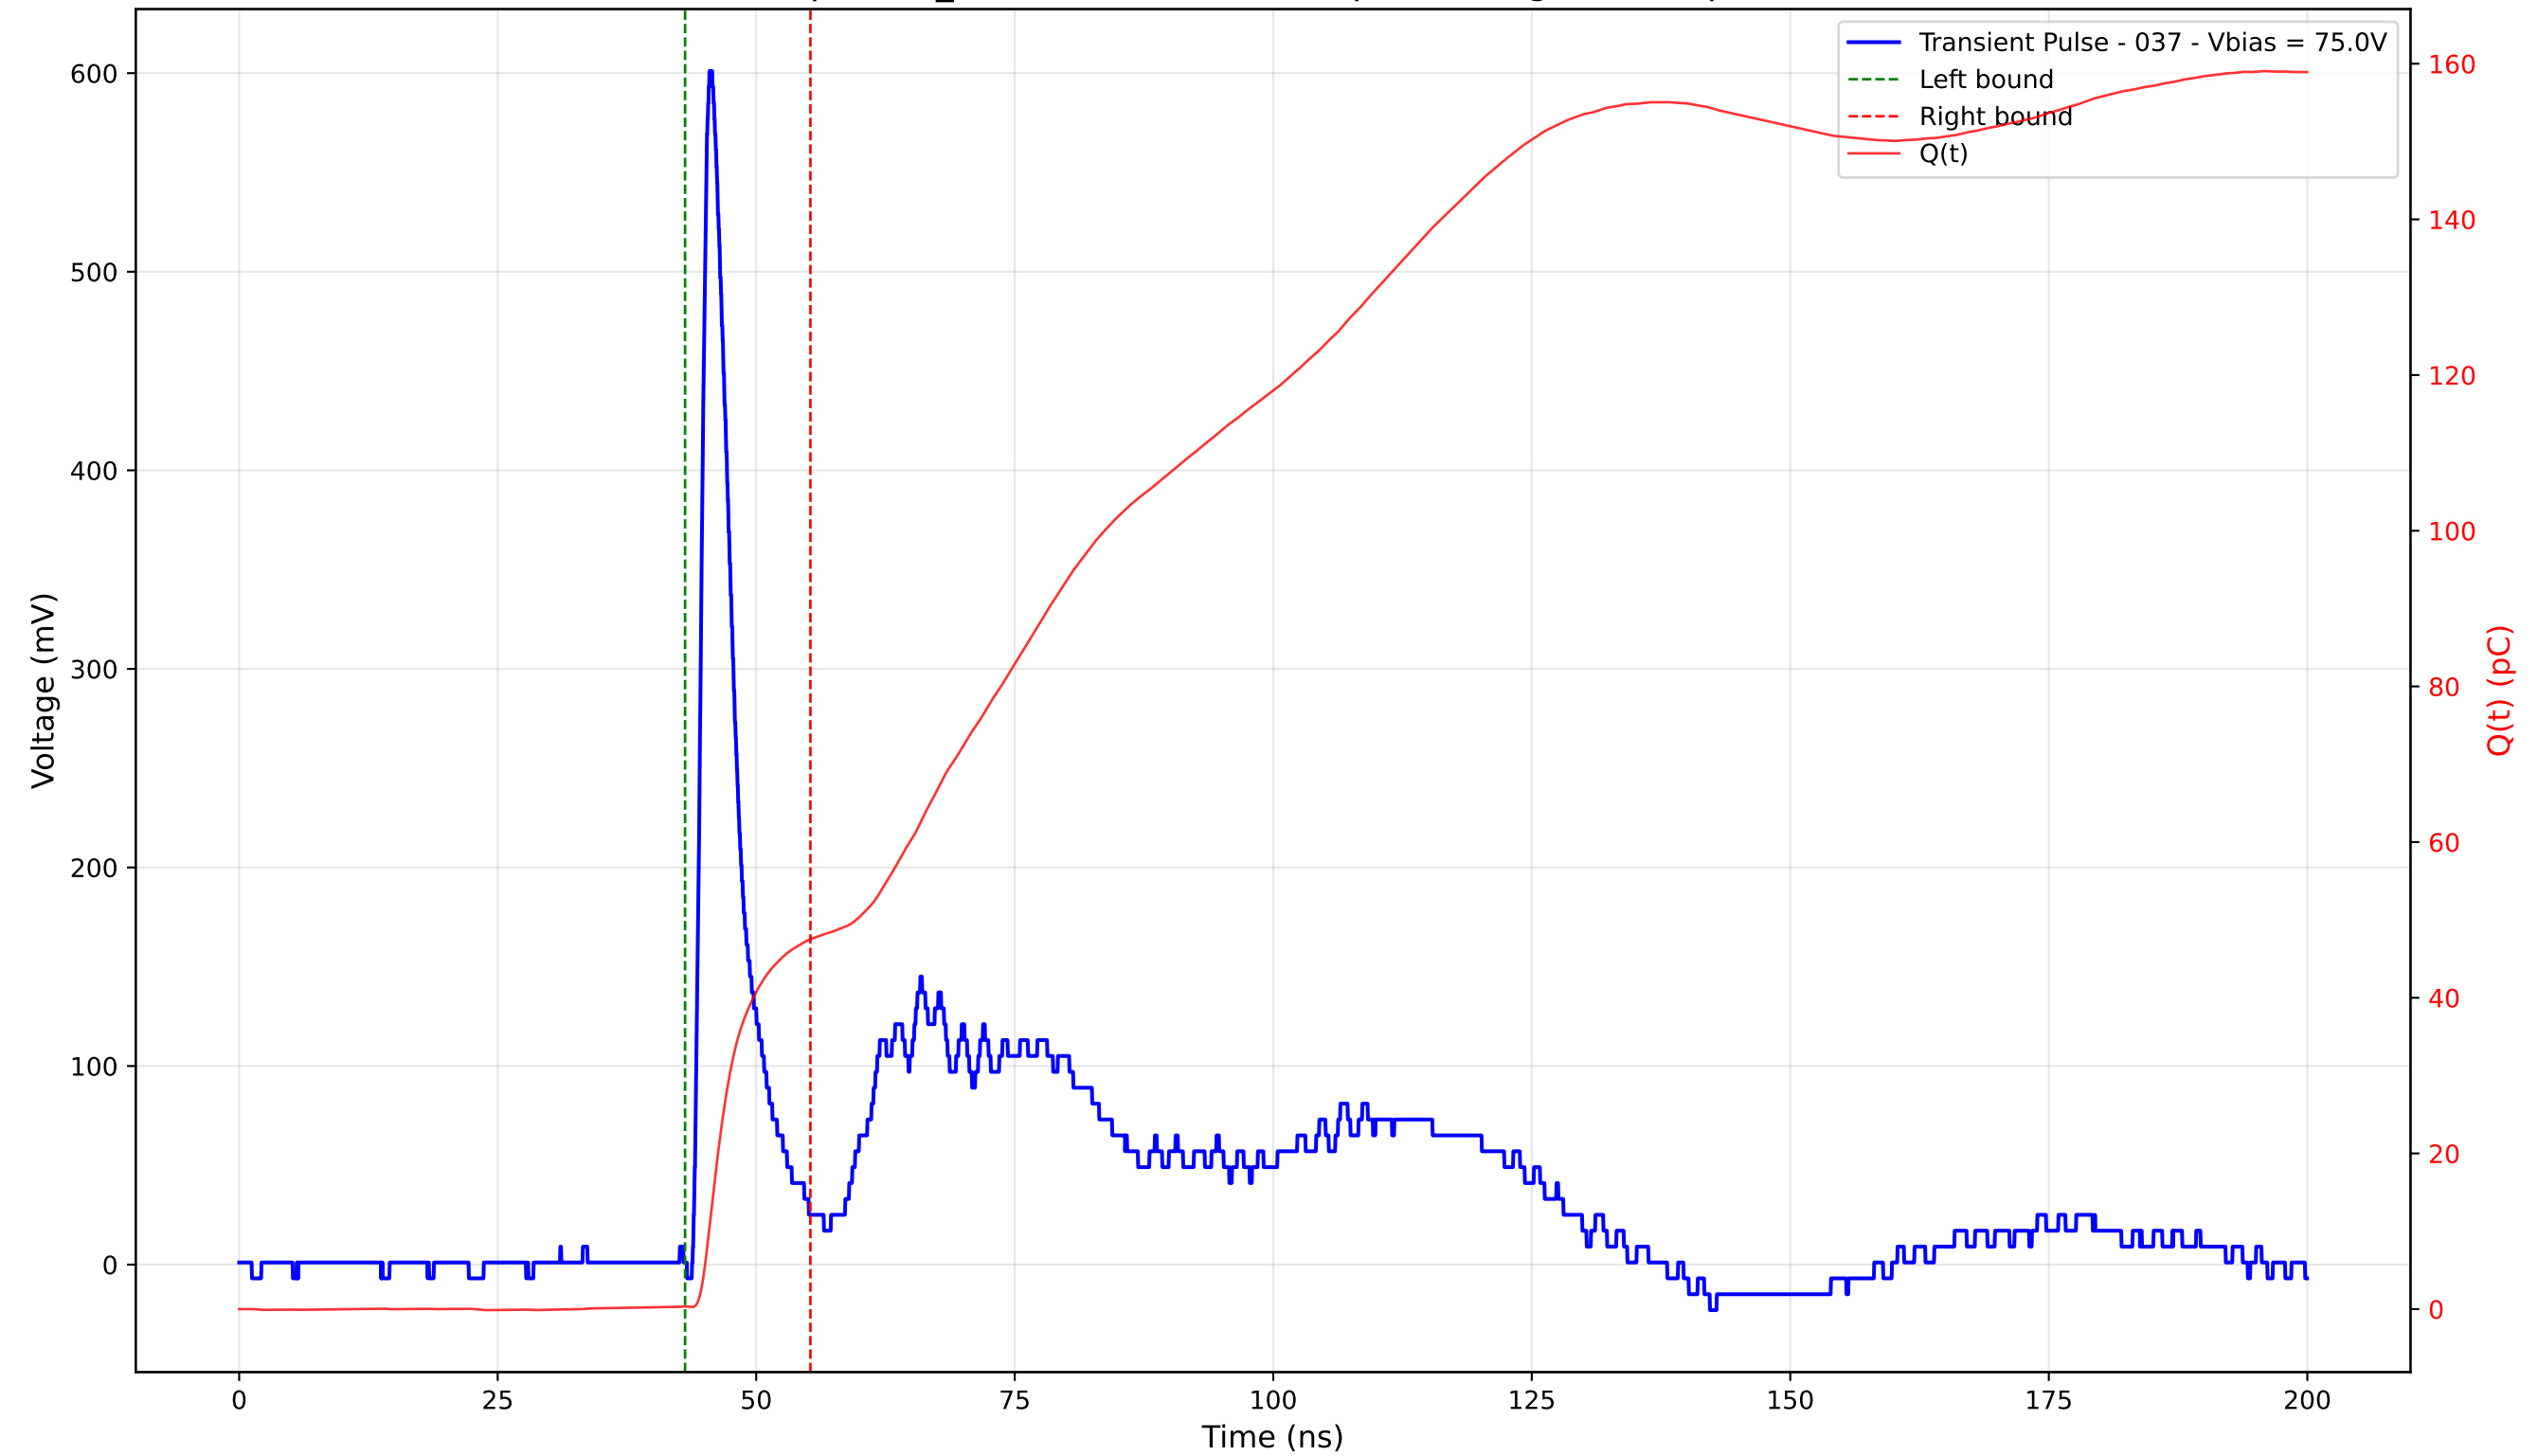


Transient Pulse - Sample: TD_4004 - Position: 190.0 μm - Charge: 47.02 pC - Rise Time: 1.02 ns

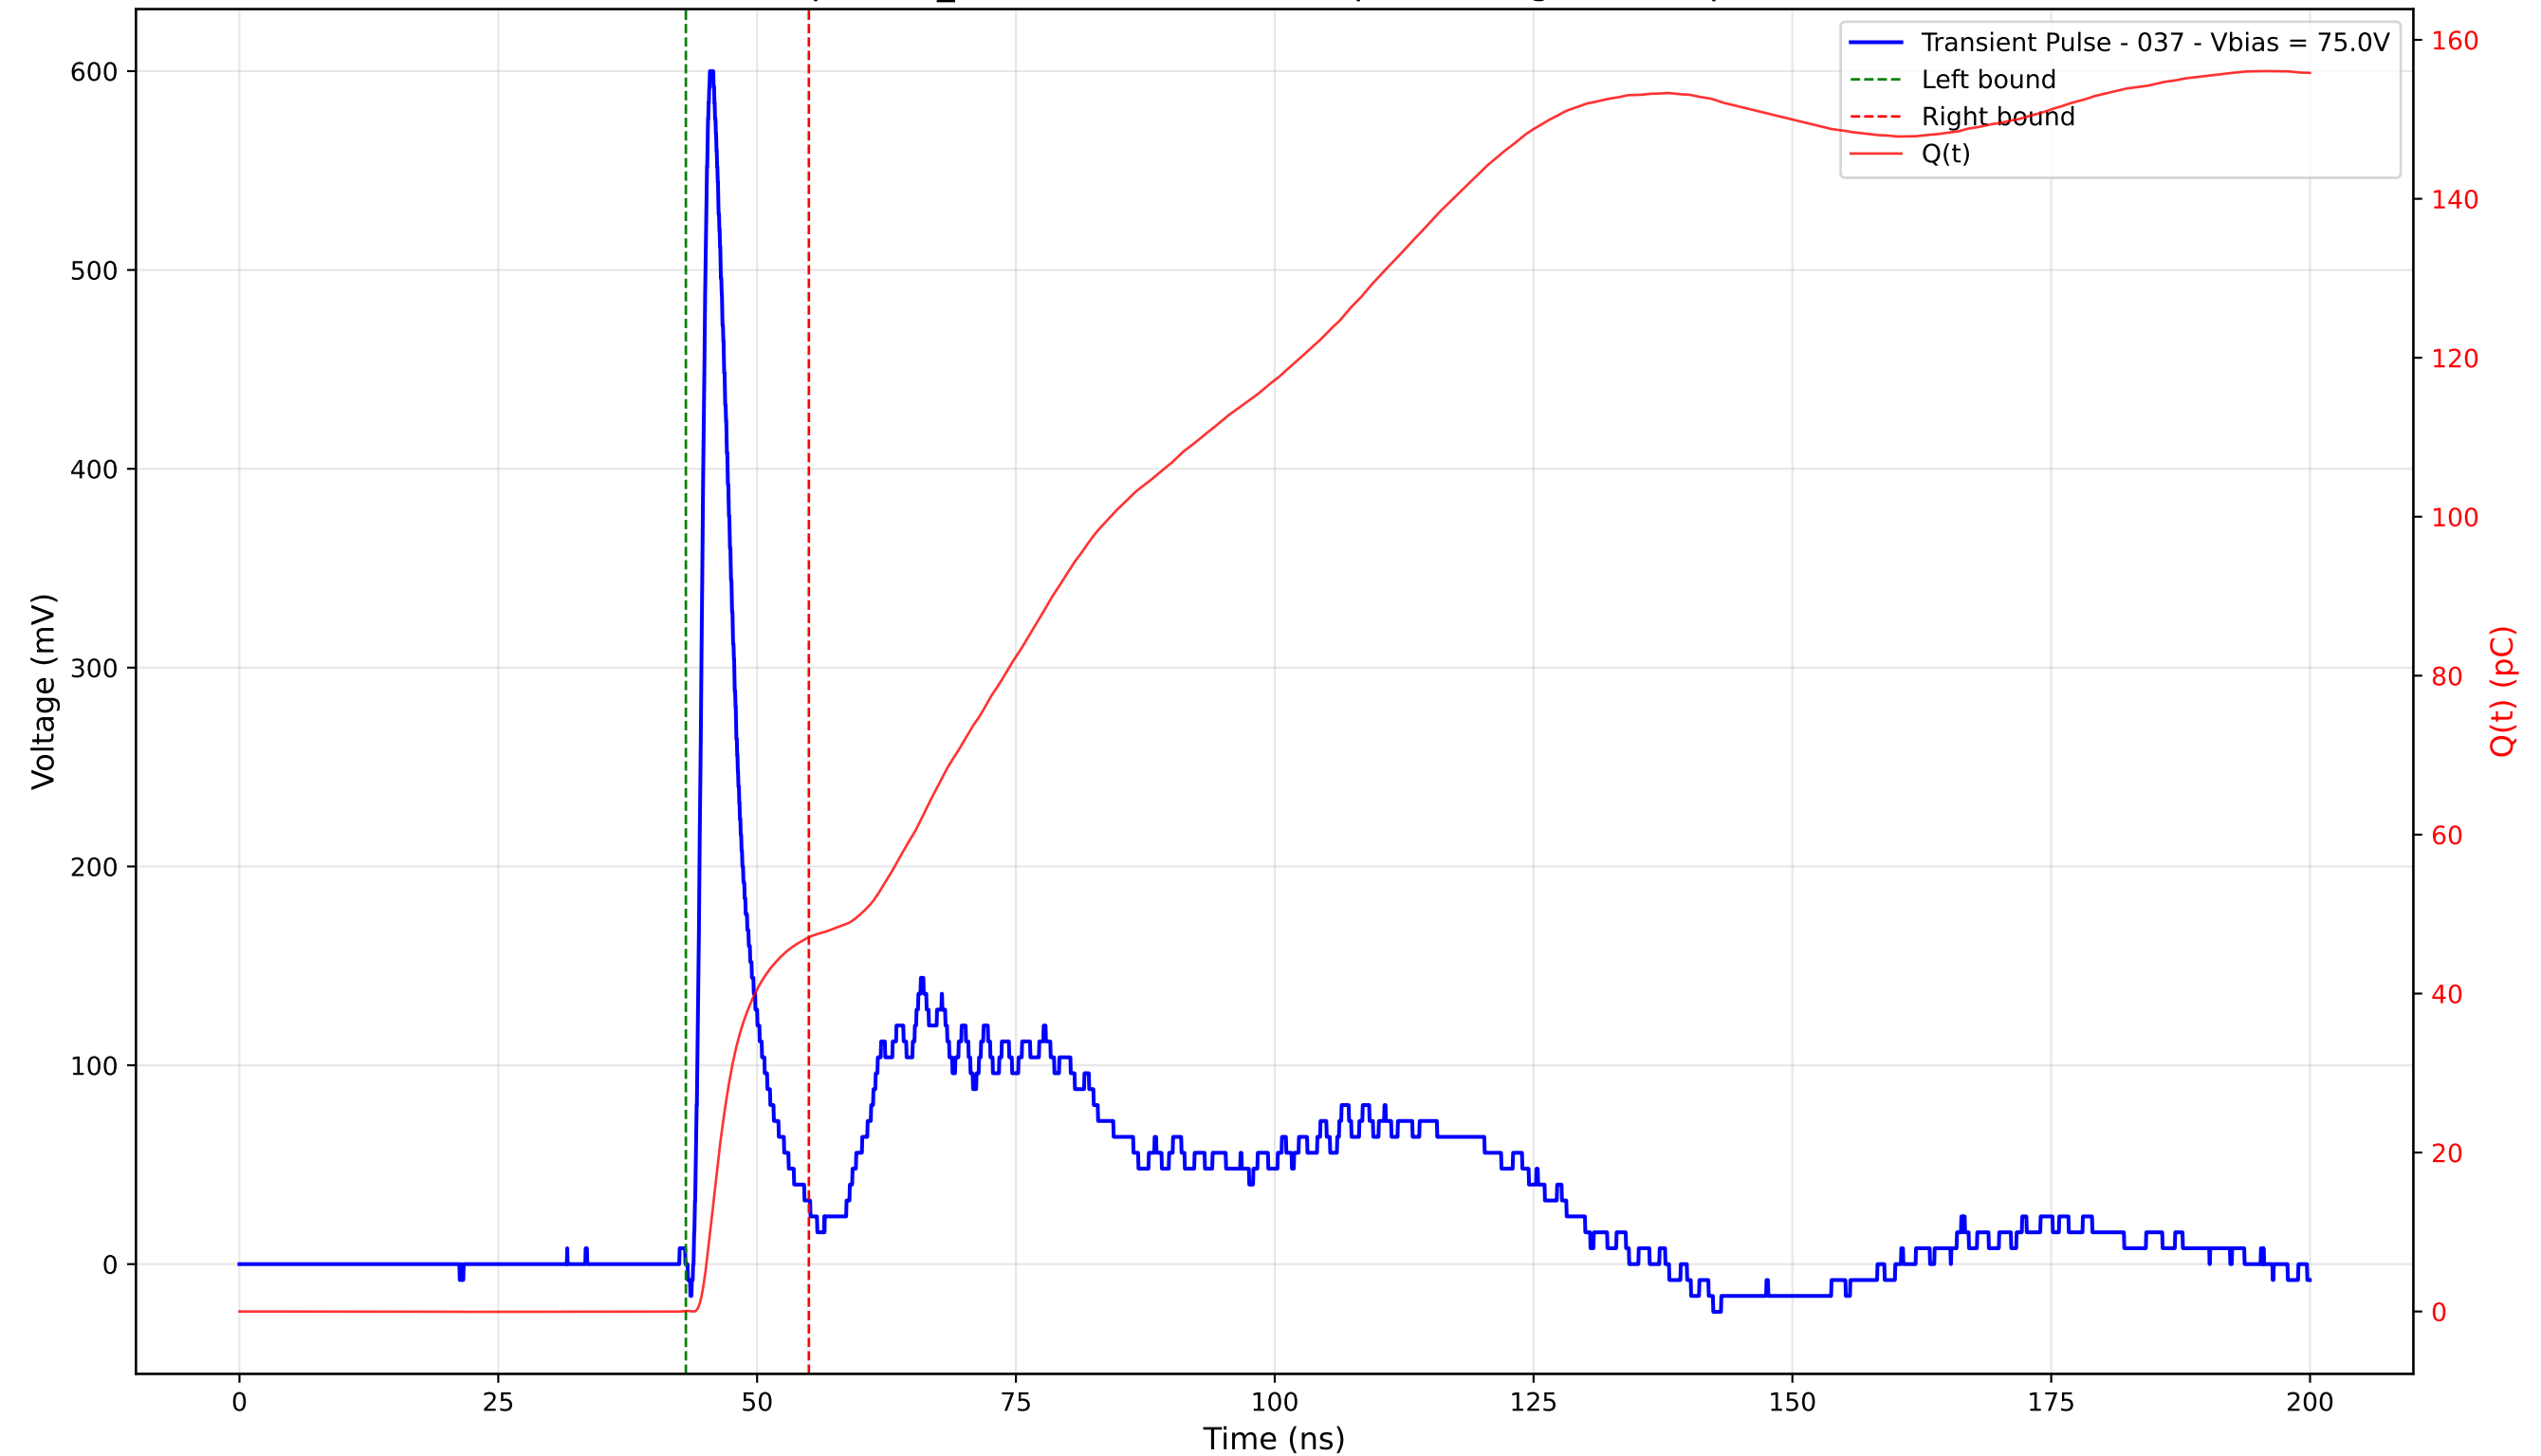


Transient Pulse - Sample: TD_4004 - Position: 195.0 μm - Charge: 46.75 pC - Rise Time: 1.04 ns

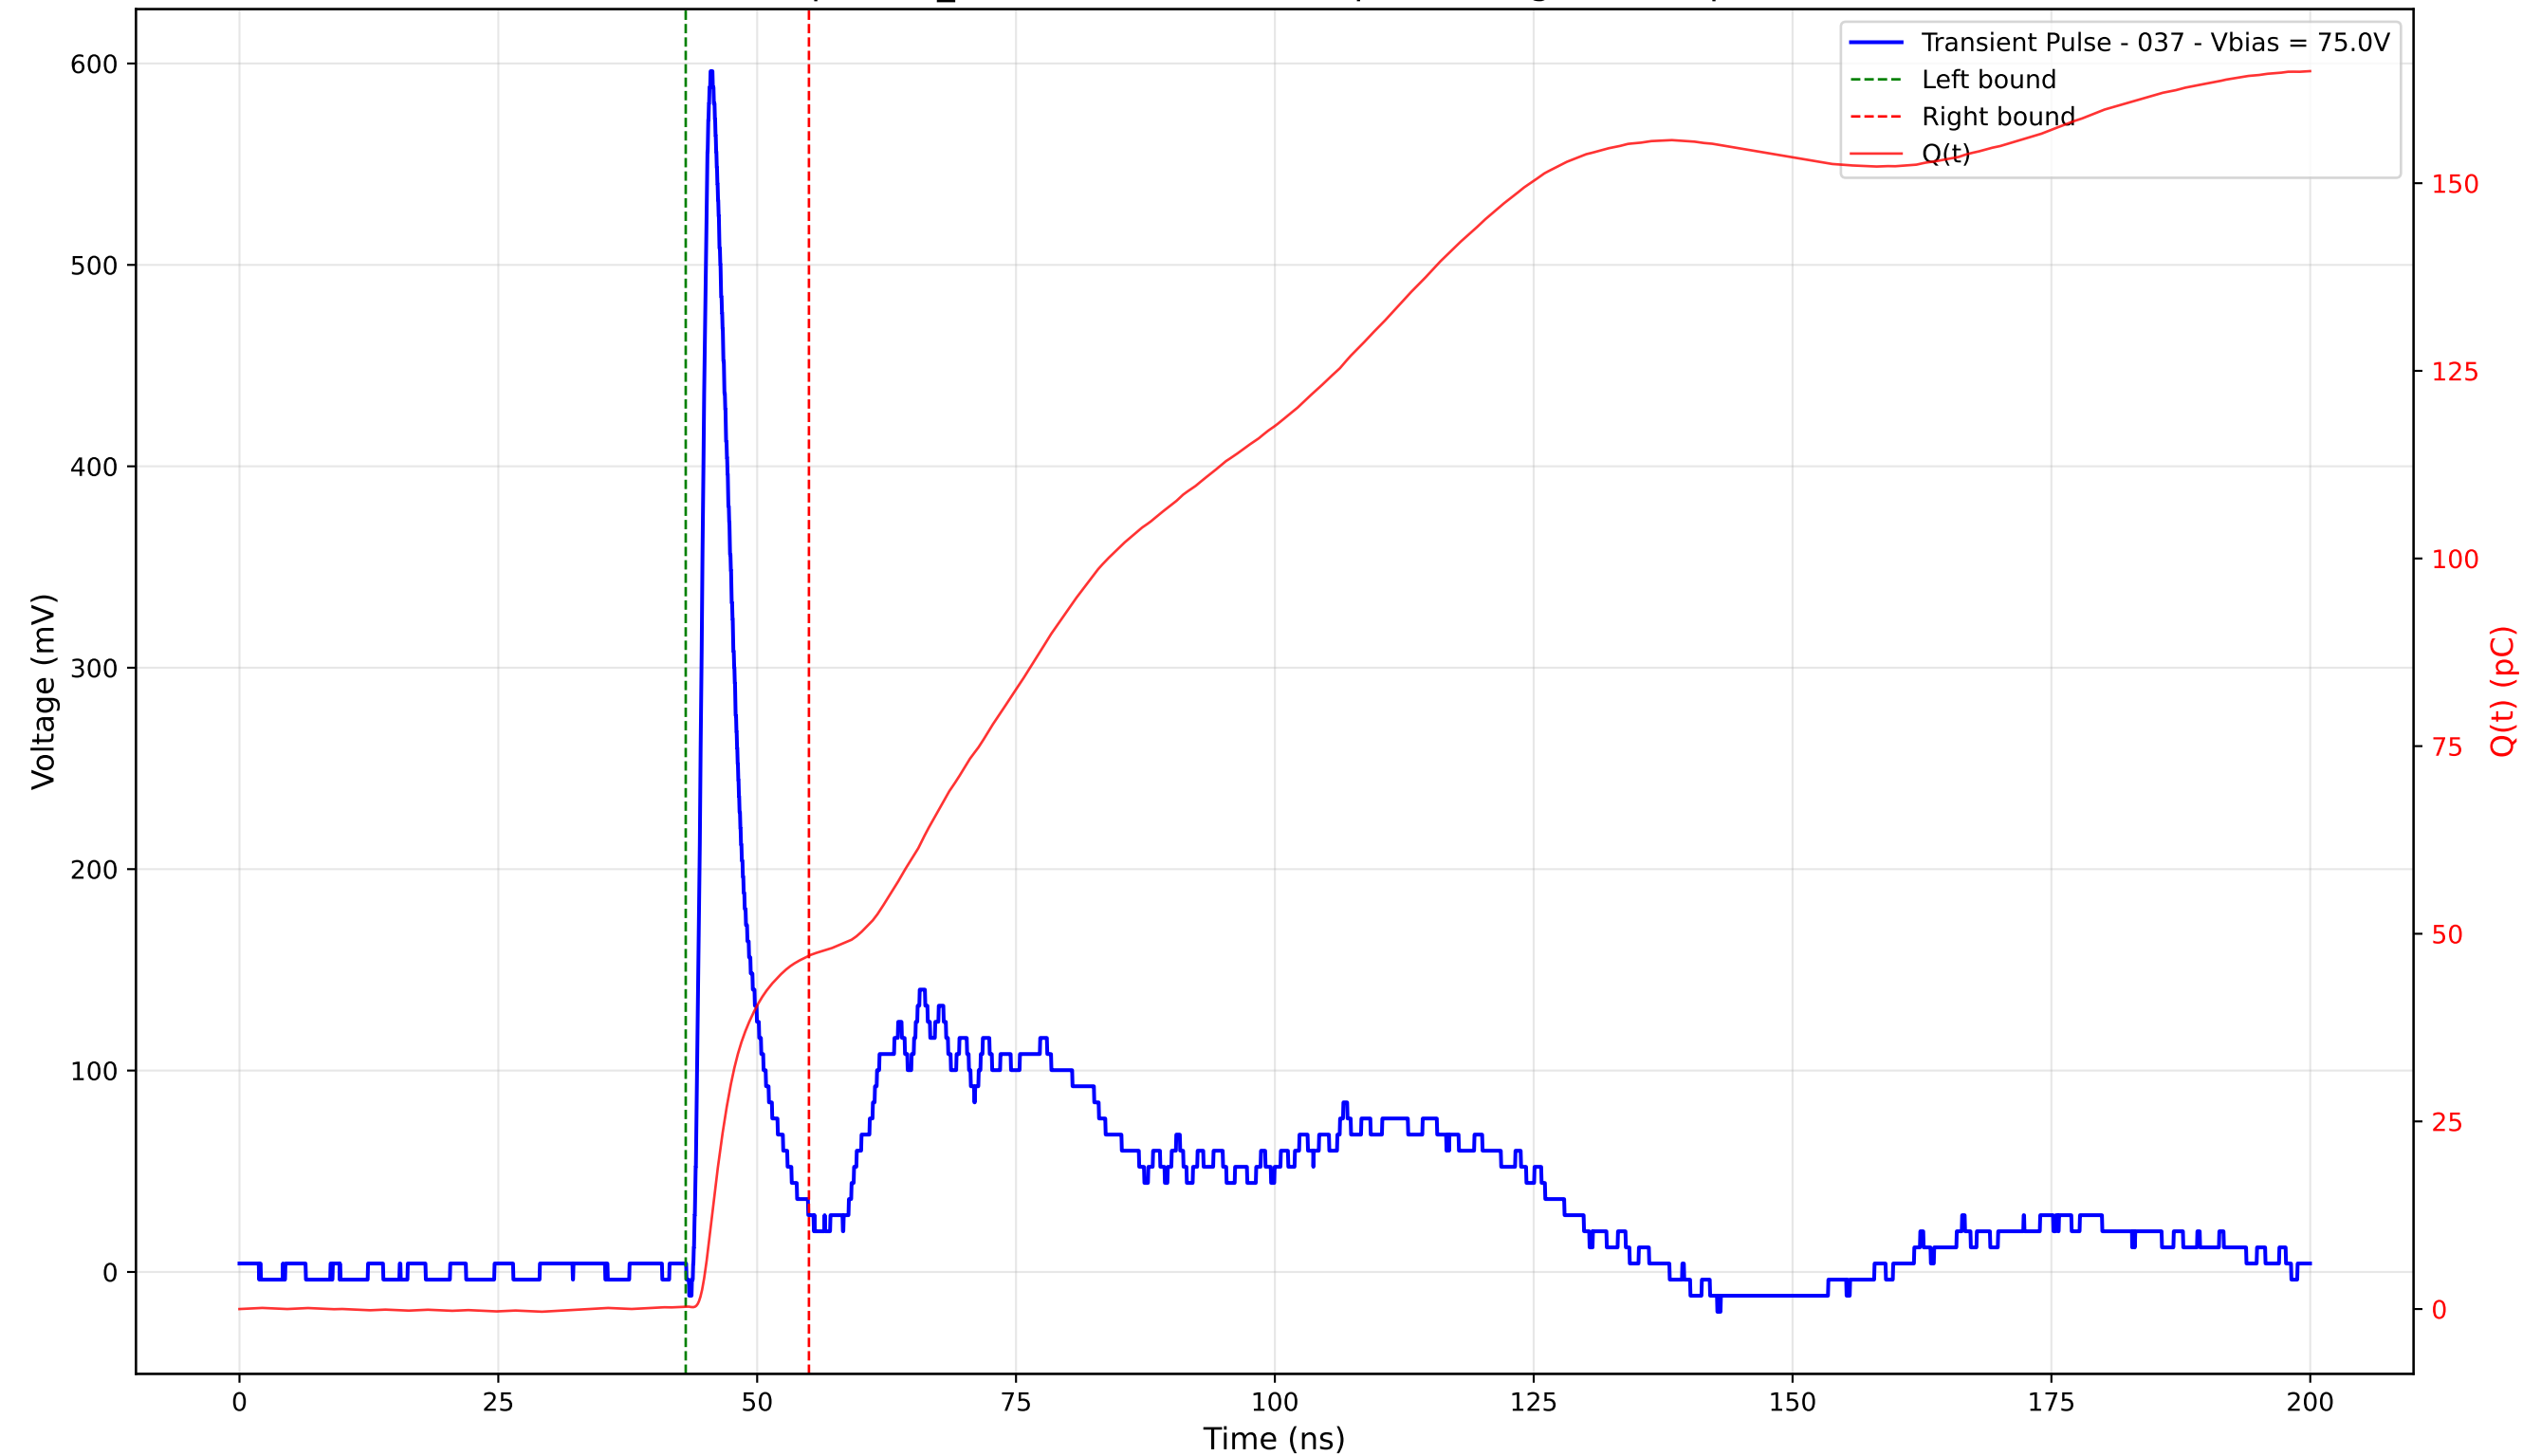


Transient Pulse - Sample: TD_4004 - Position: 200.0 μm - Charge: 46.44 pC - Rise Time: 1.06 ns

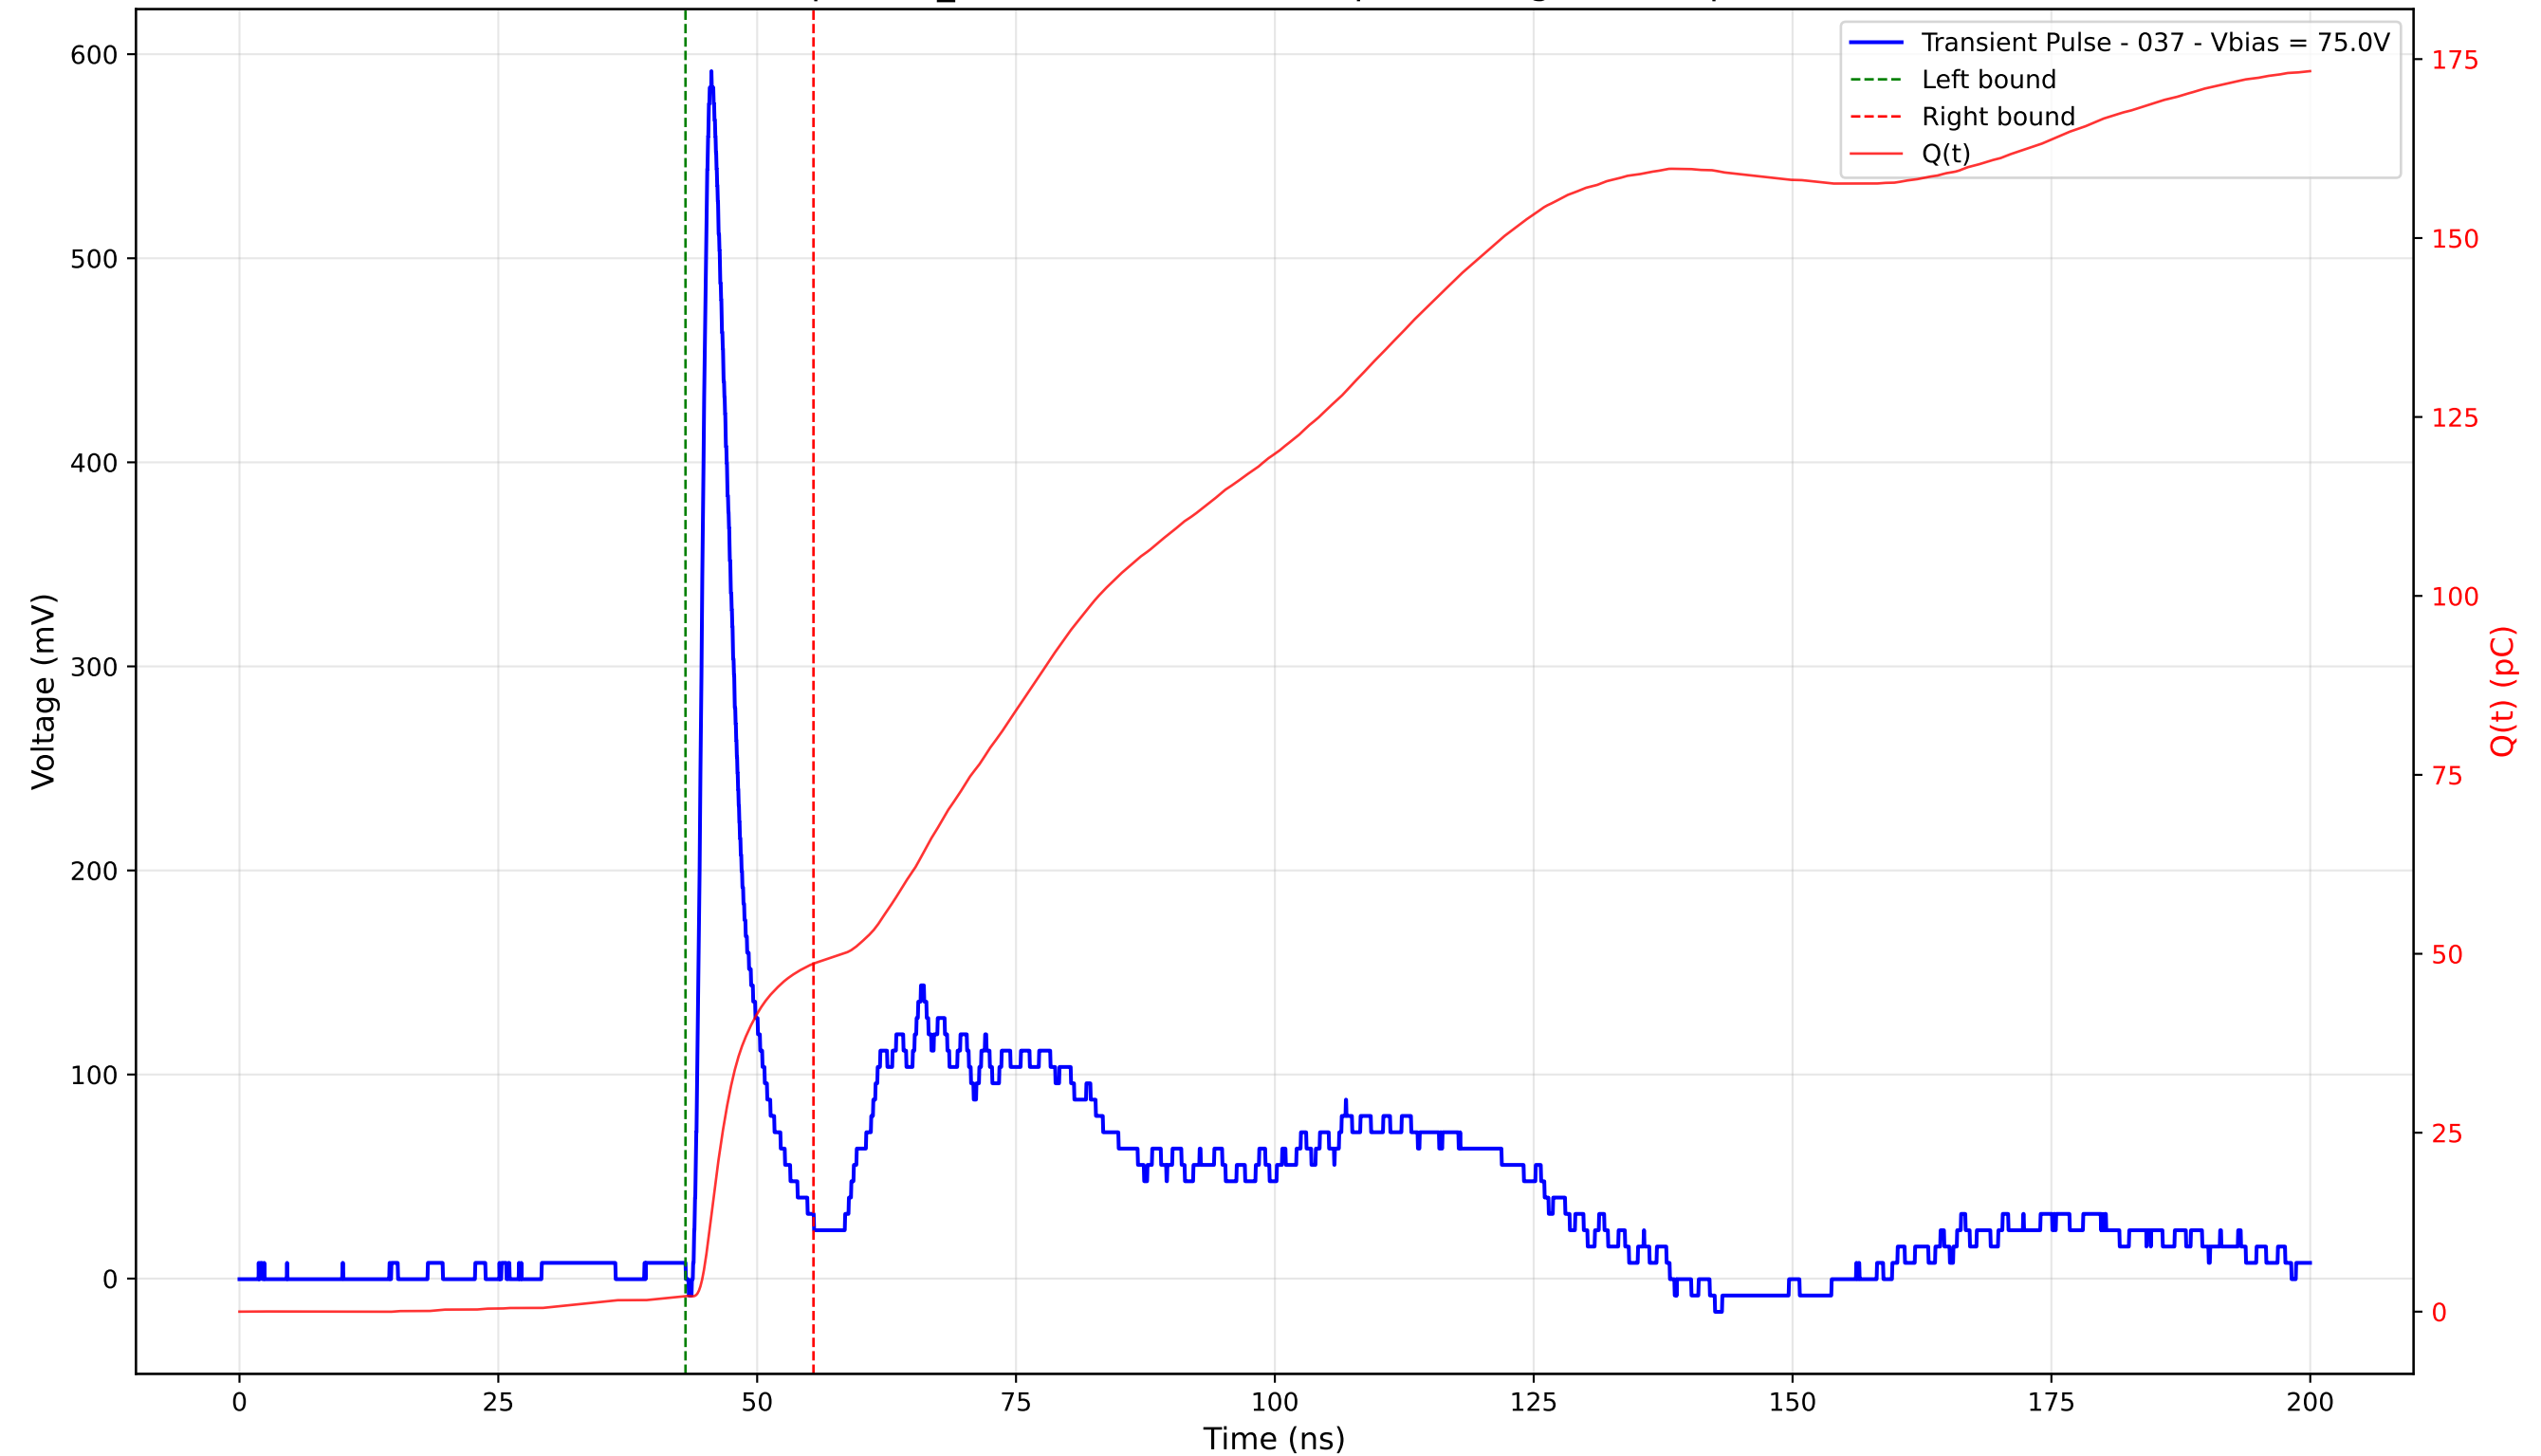


Transient Pulse - Sample: TD_4004 - Position: 205.0 μm - Charge: 43.43 pC - Rise Time: 1.03 ns

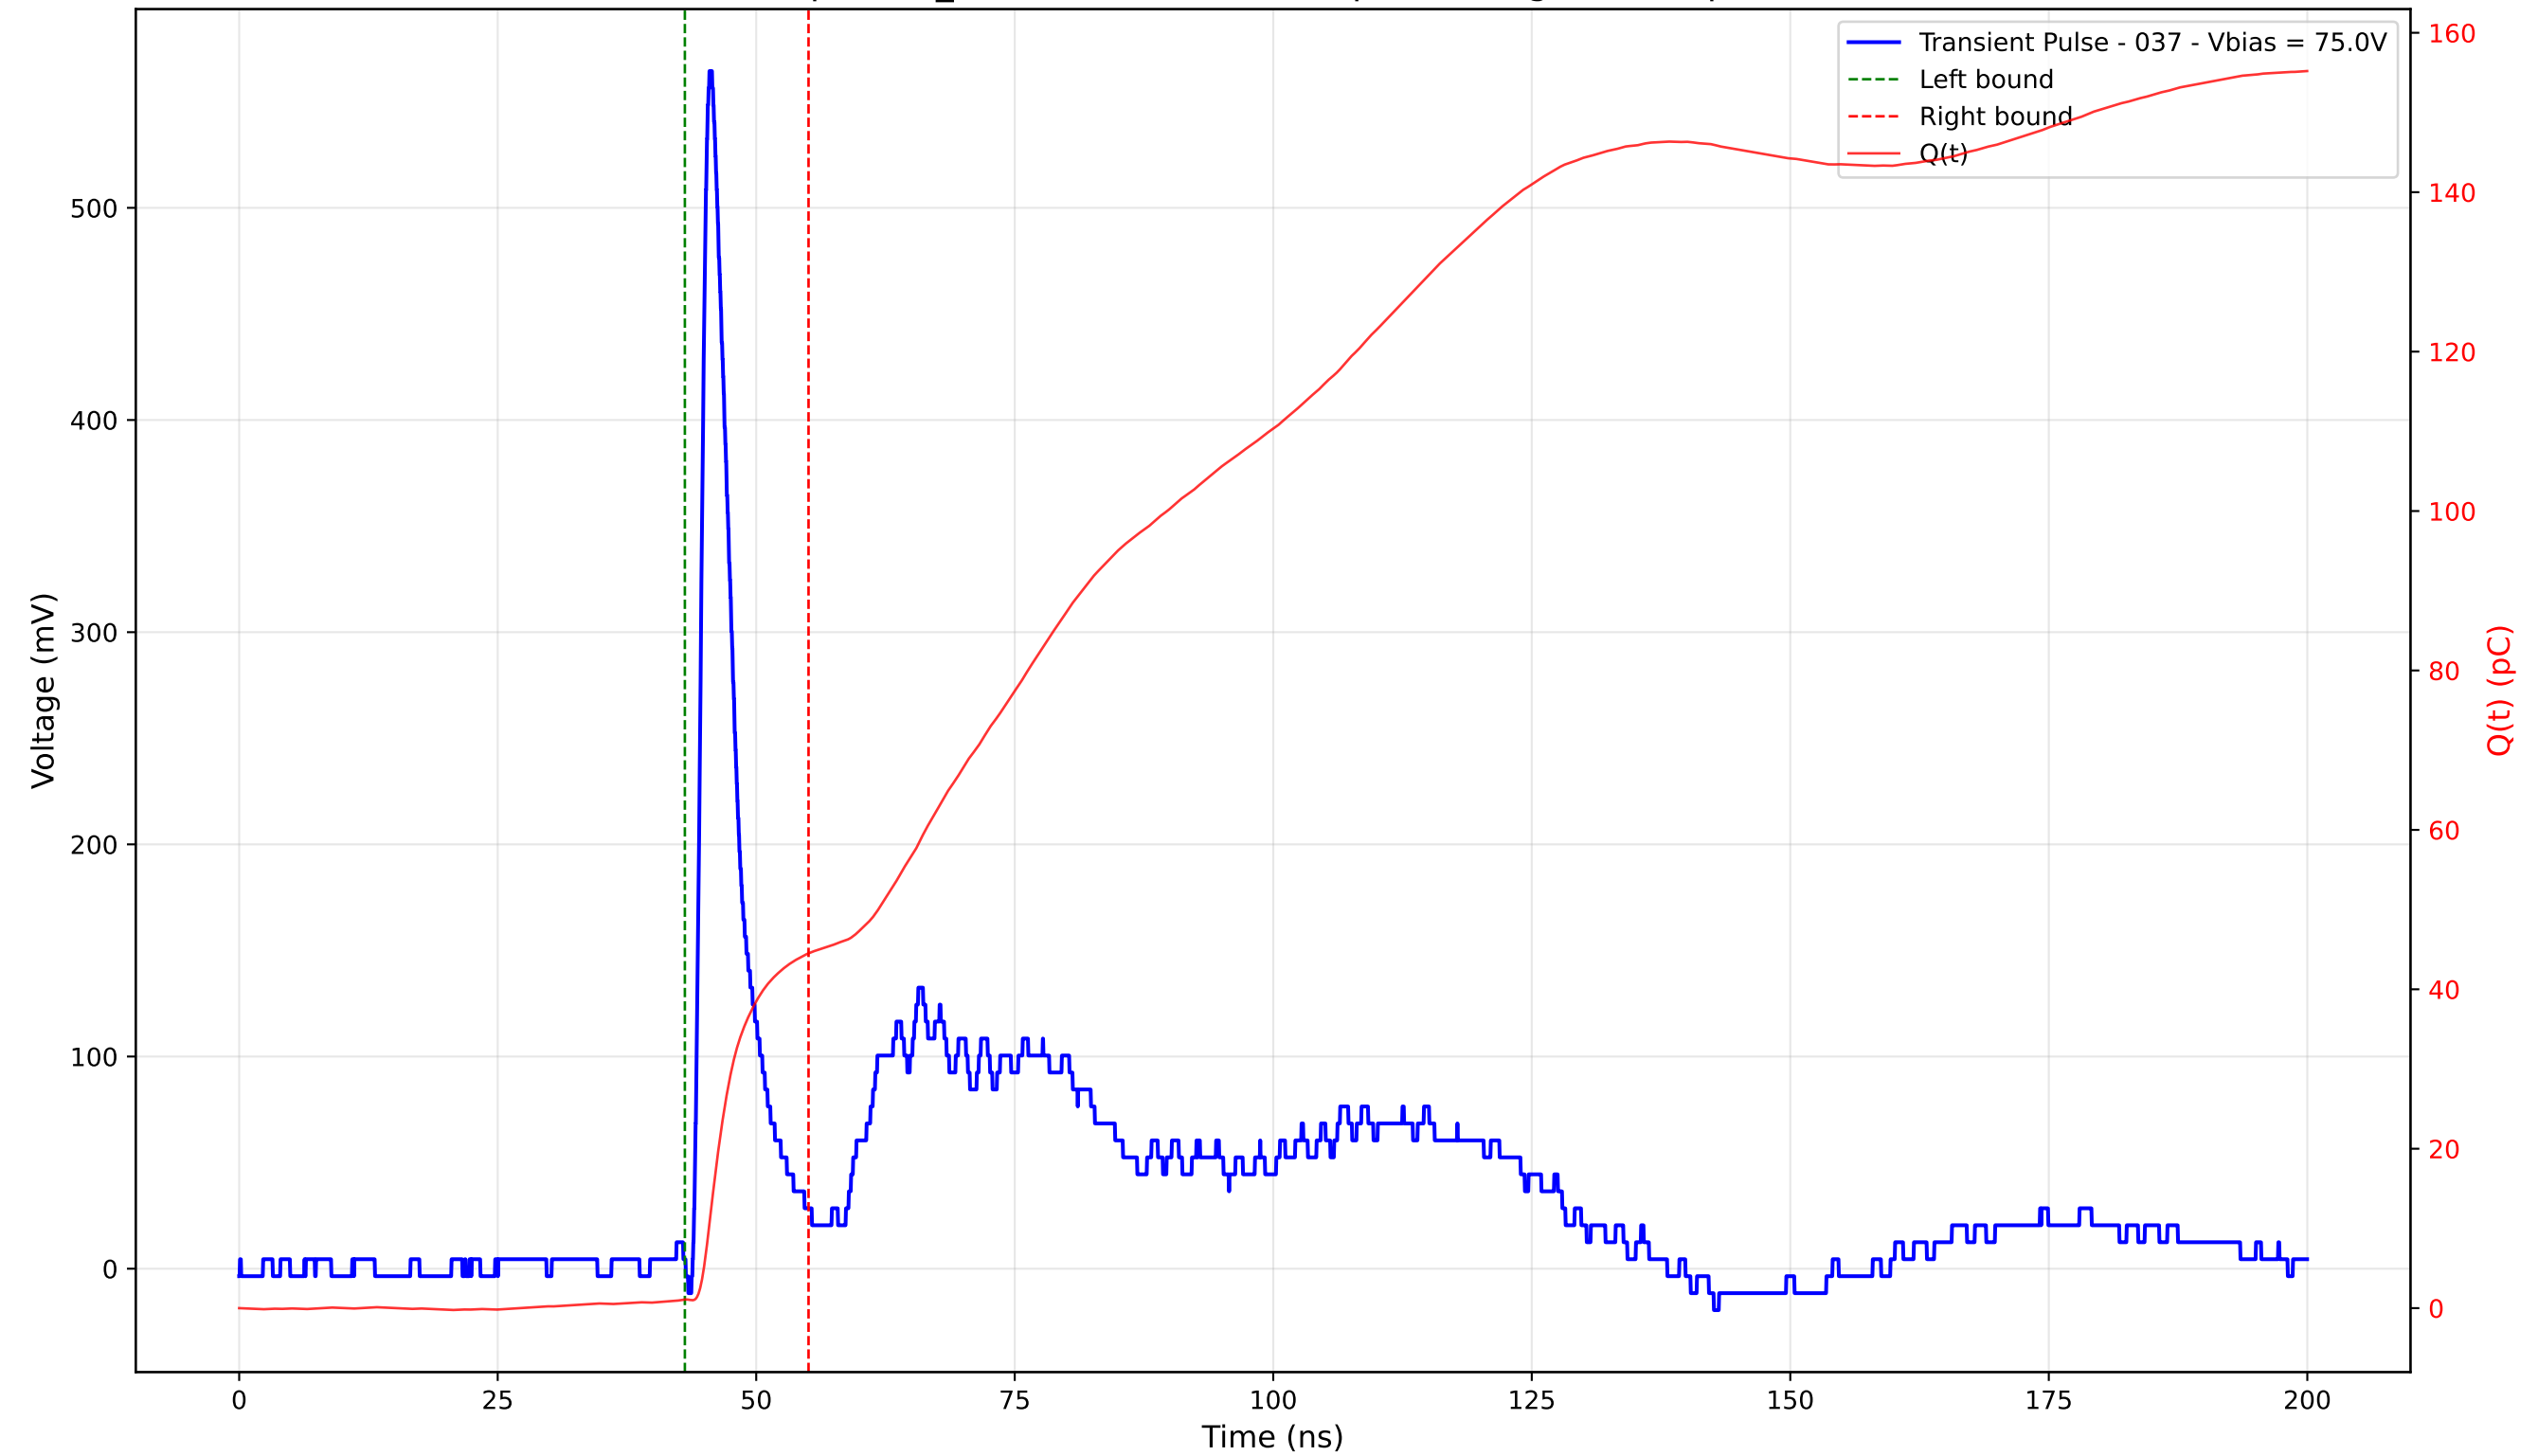


Transient Pulse - Sample: TD_4004 - Position: 210.0 μm - Charge: 41.17 pC - Rise Time: 1.06 ns

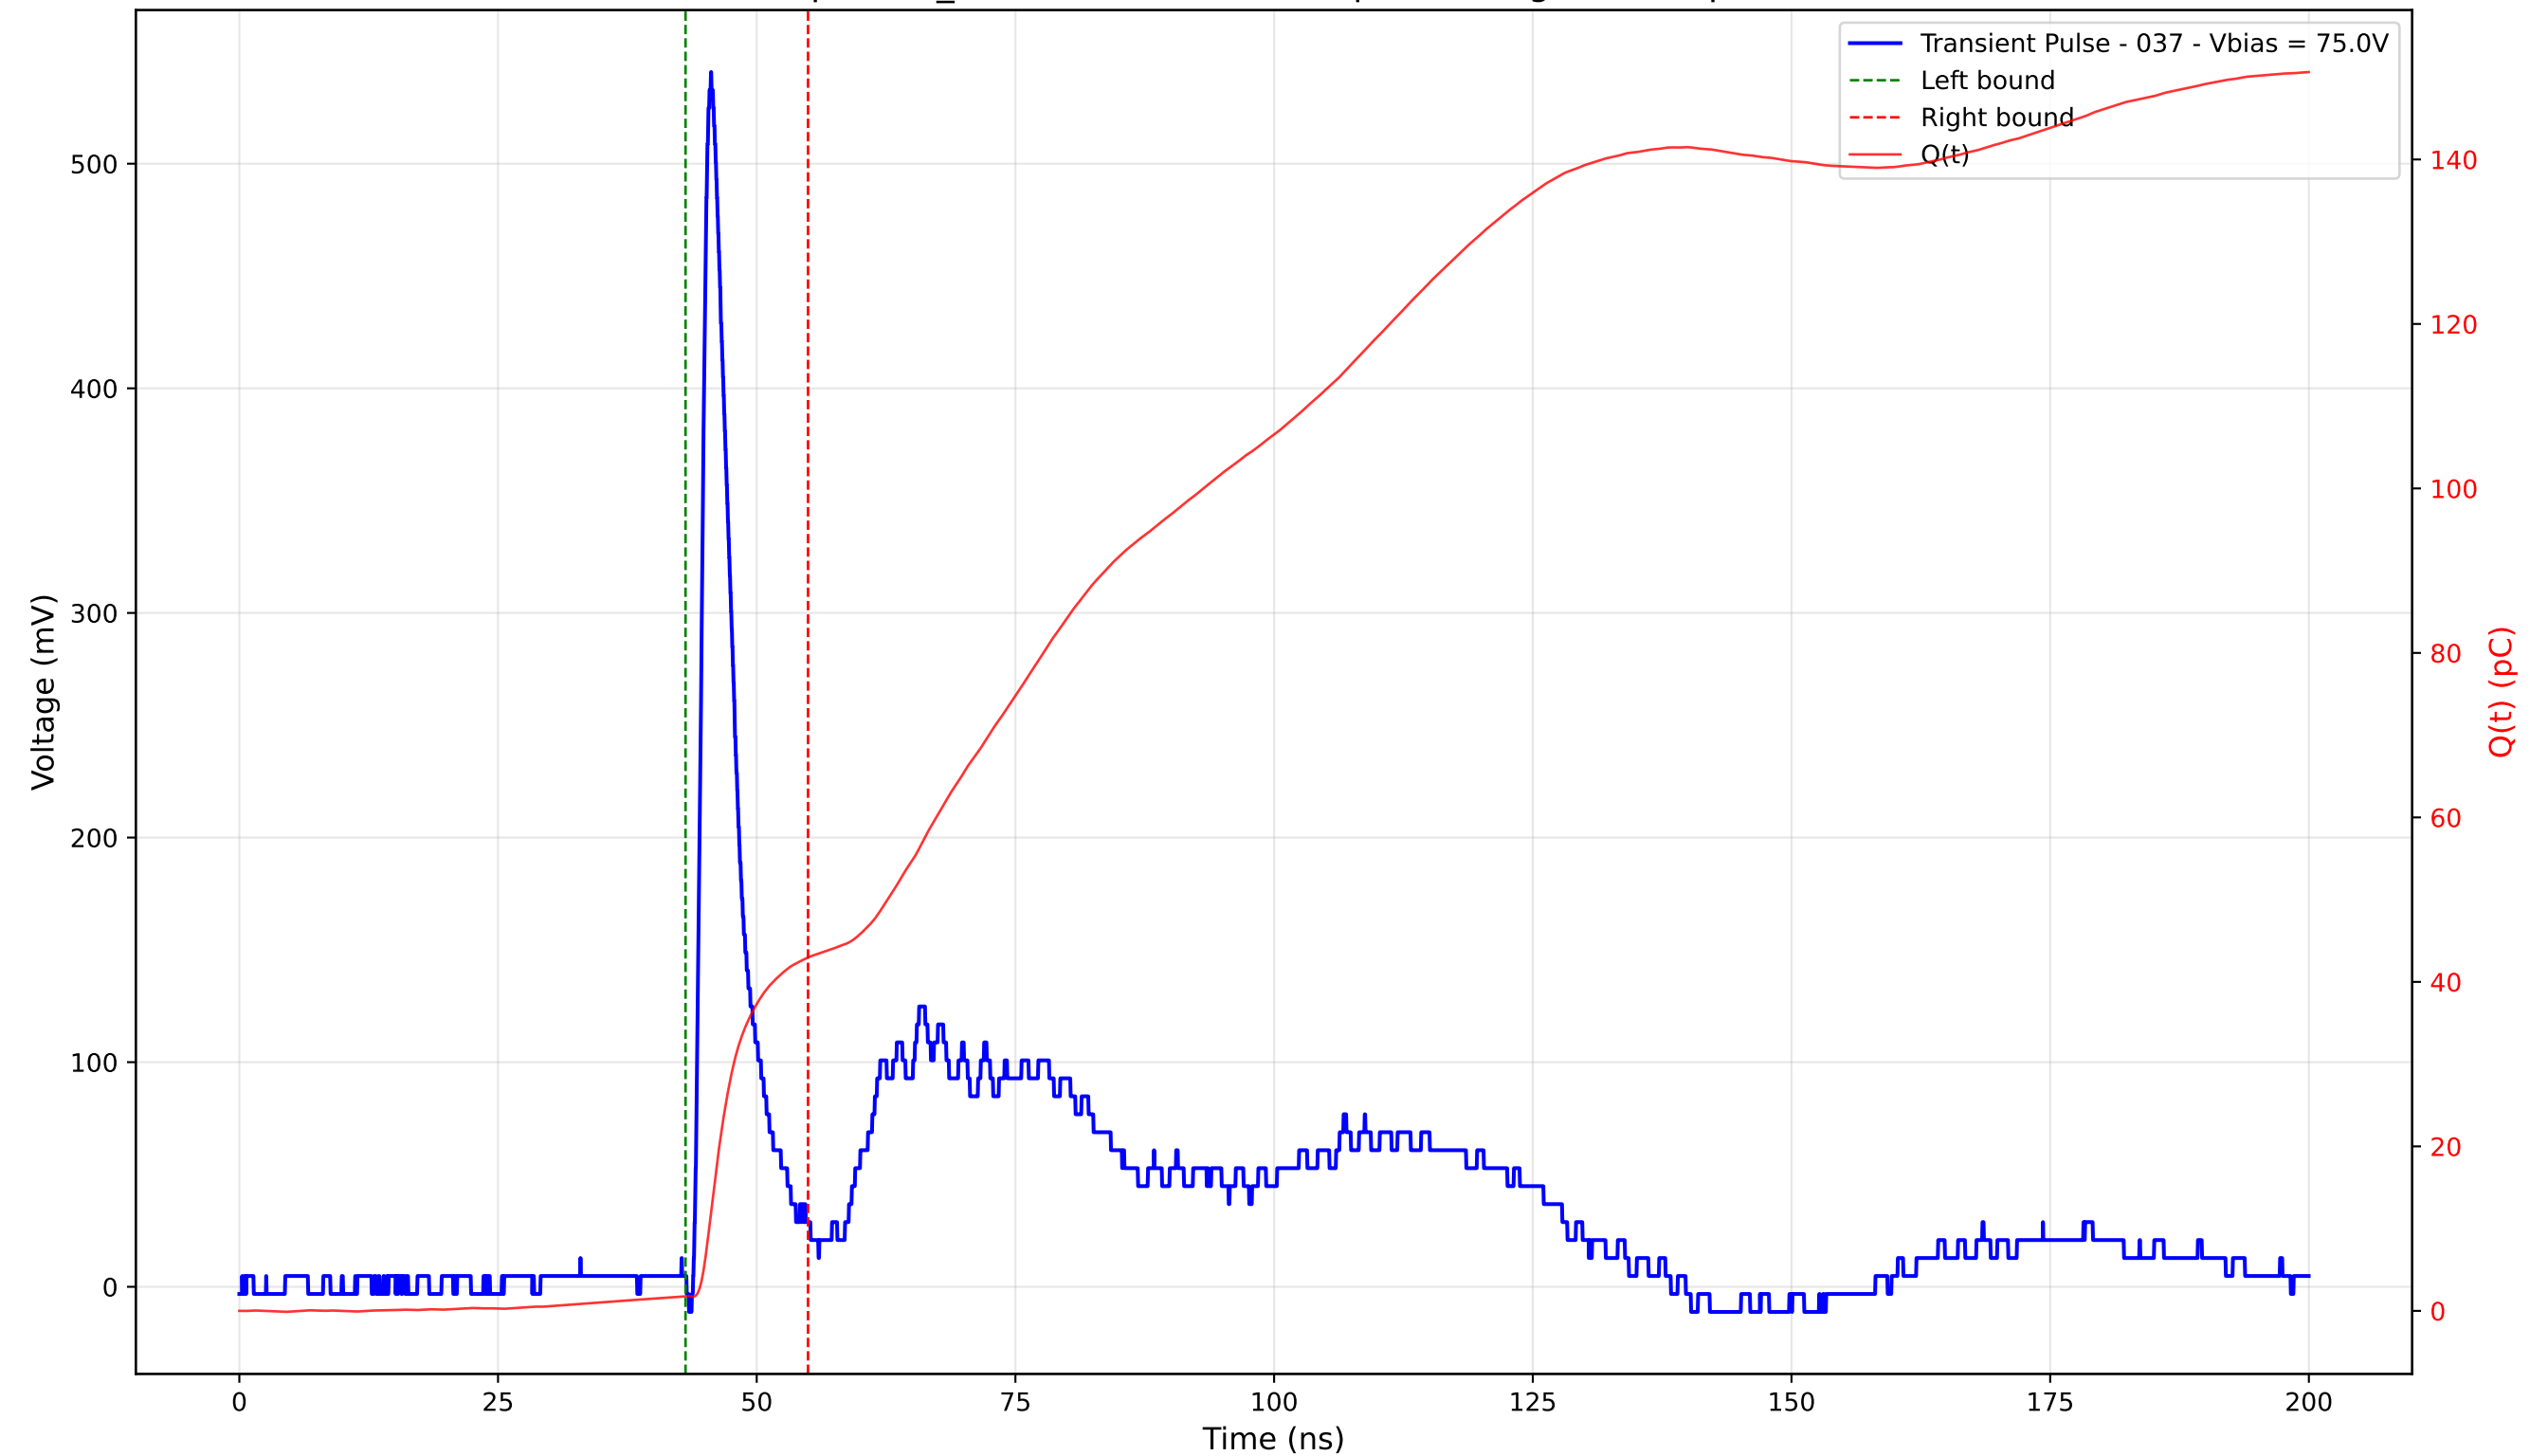


Transient Pulse - Sample: TD_4004 - Position: 215.0 μm - Charge: 39.57 pC - Rise Time: 1.05 ns

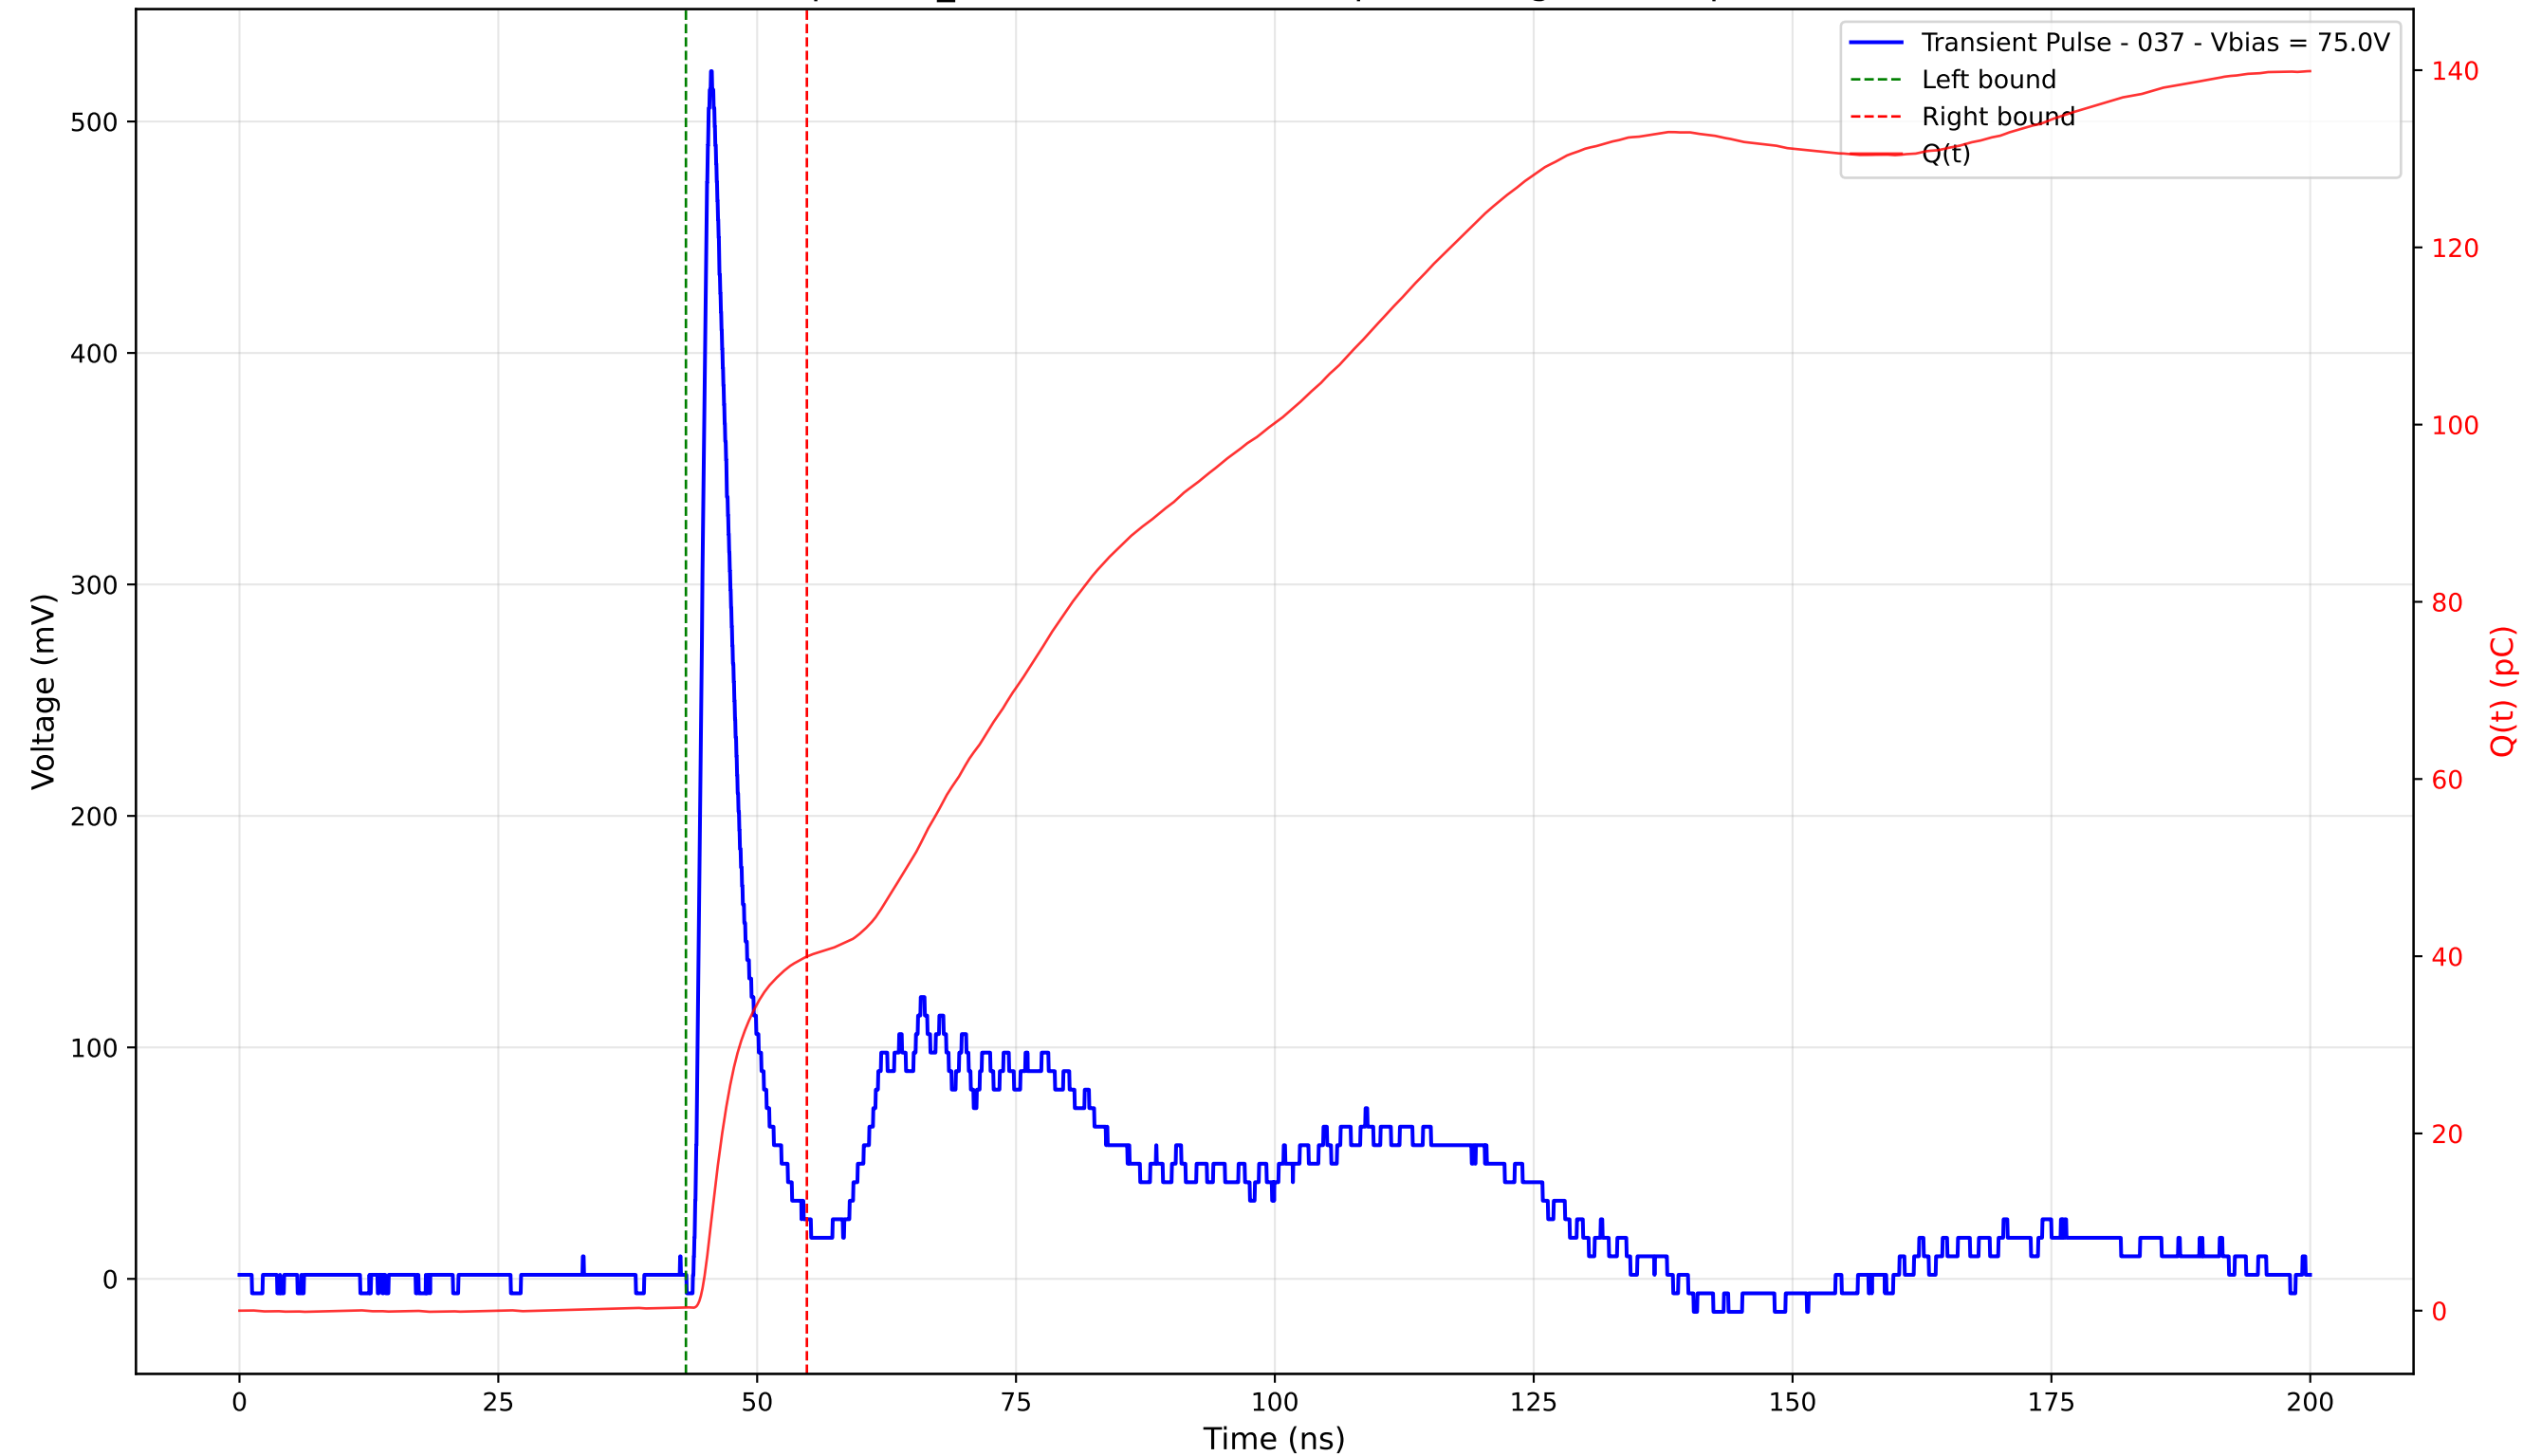


Transient Pulse - Sample: TD_4004 - Position: 220.0 μm - Charge: 39.25 pC - Rise Time: 1.01 ns

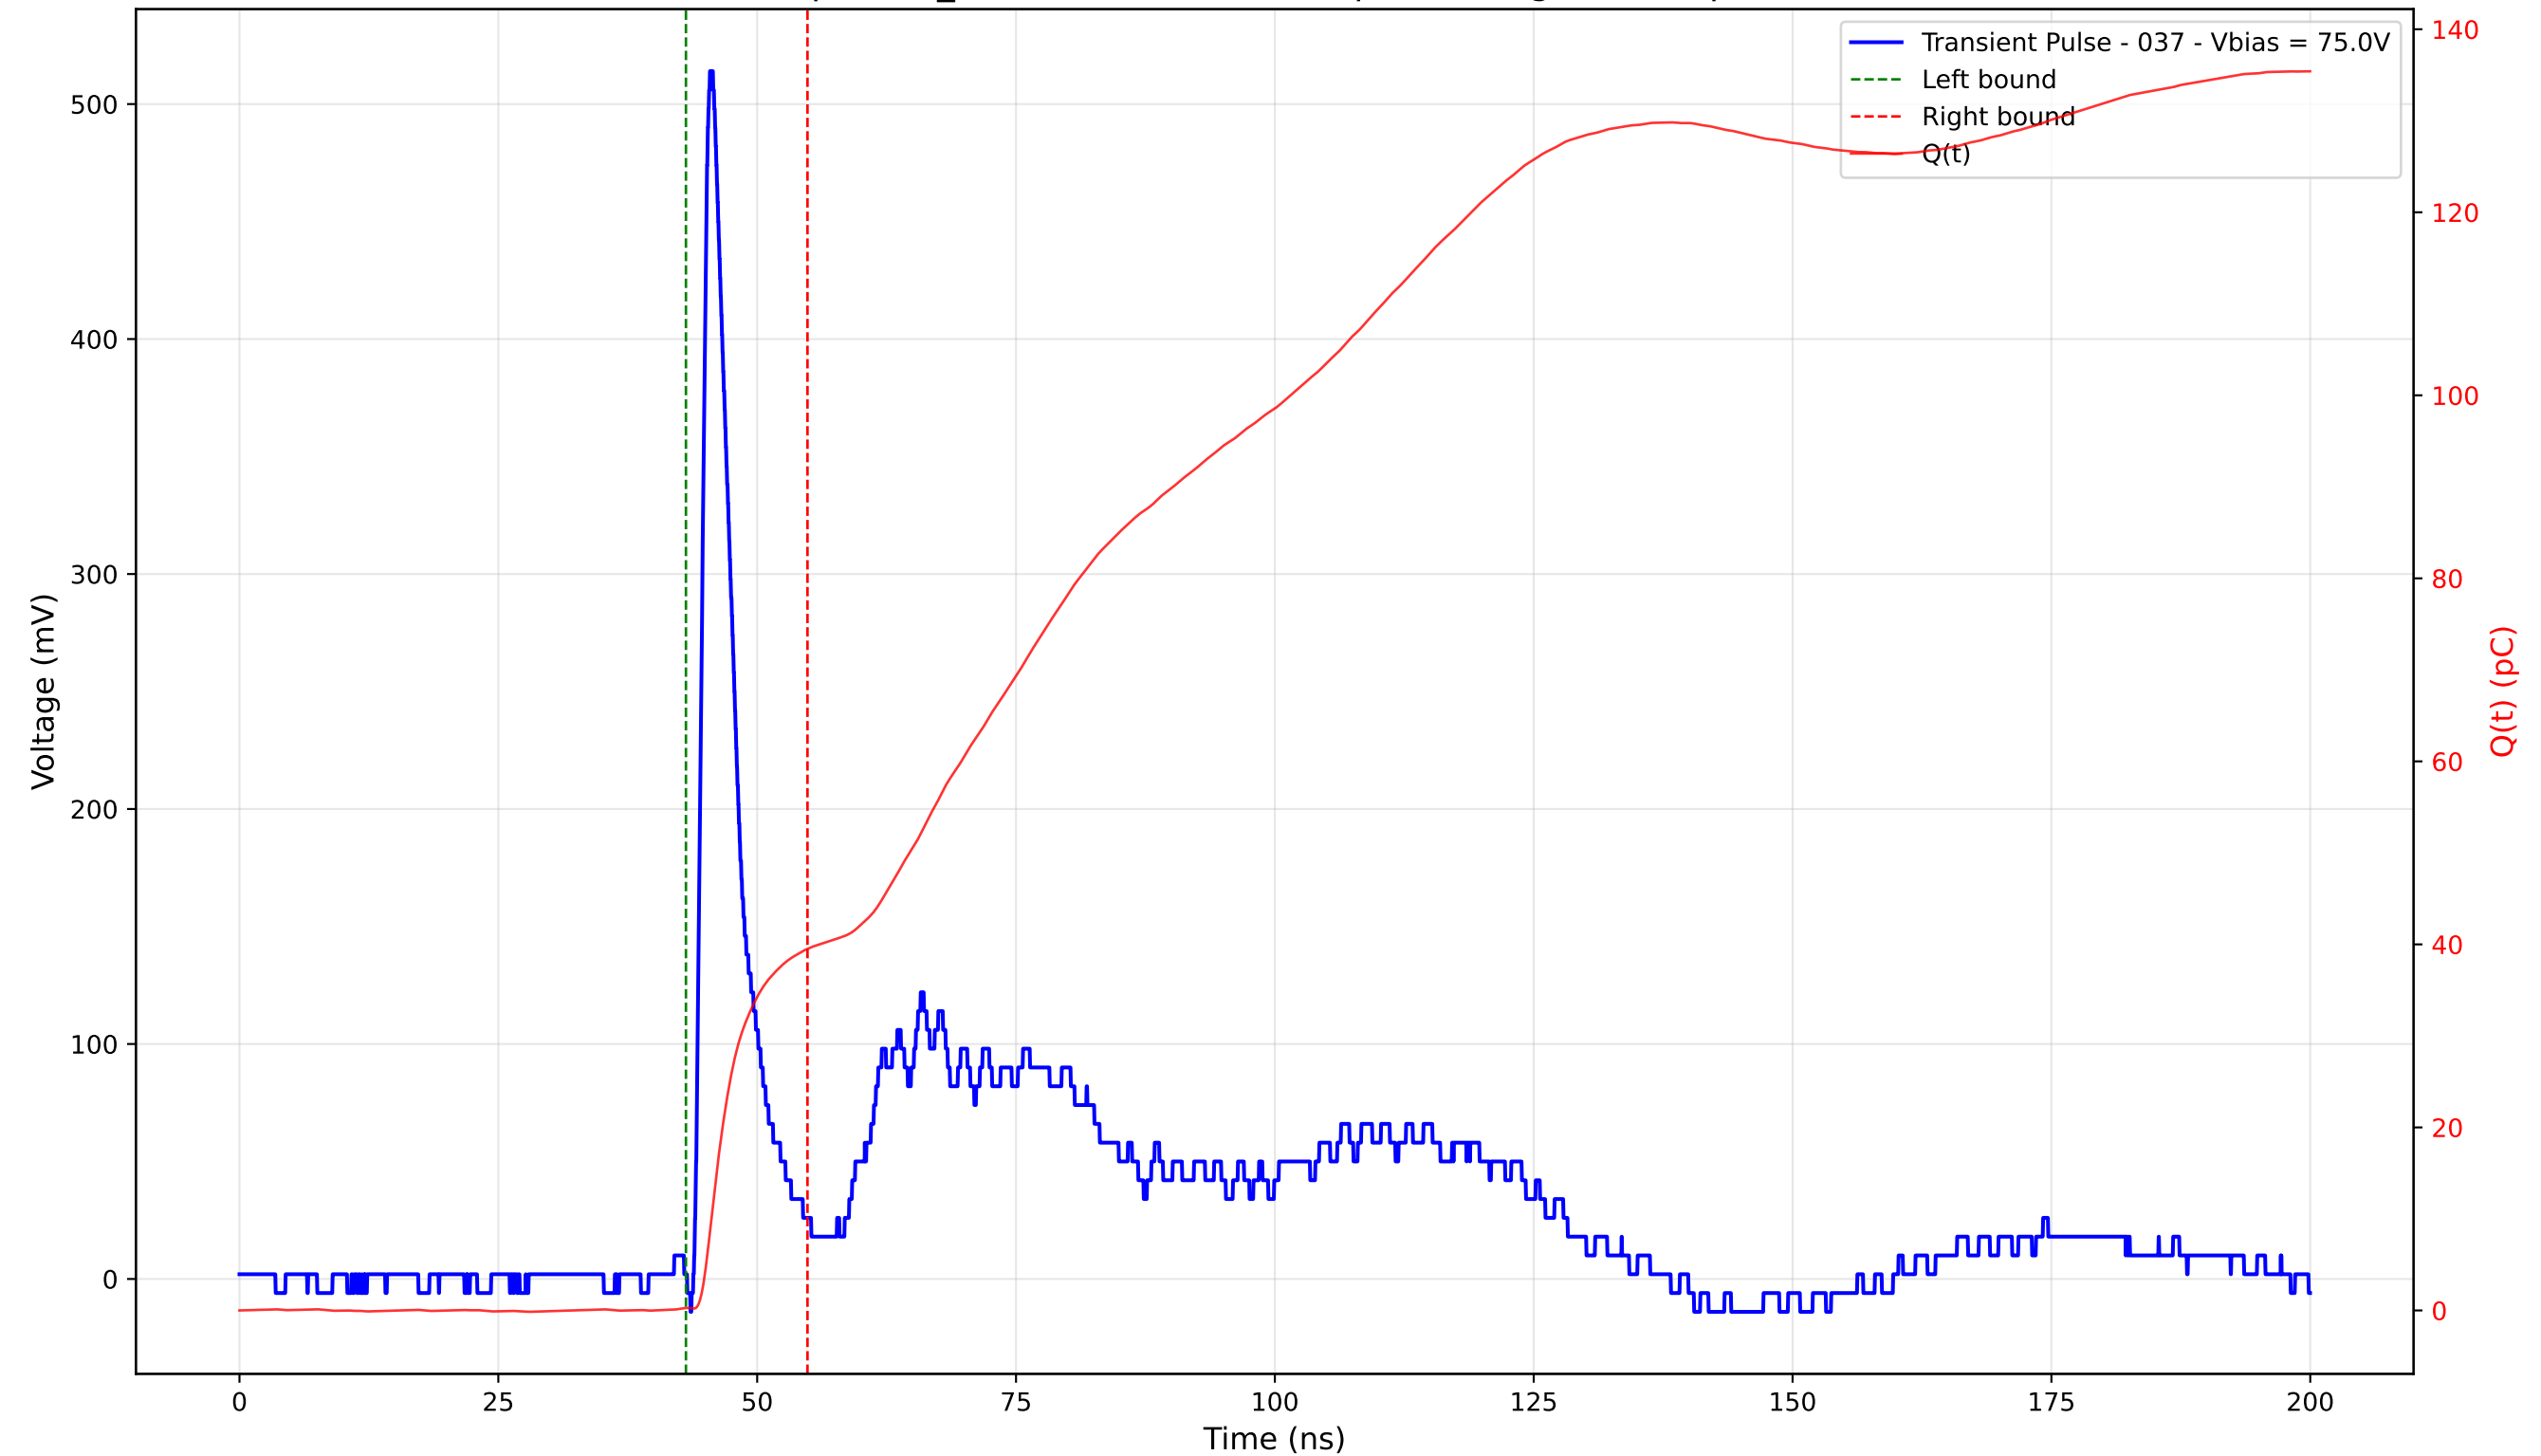


Transient Pulse - Sample: TD_4004 - Position: 225.0 μm - Charge: 38.71 pC - Rise Time: 1.04 ns

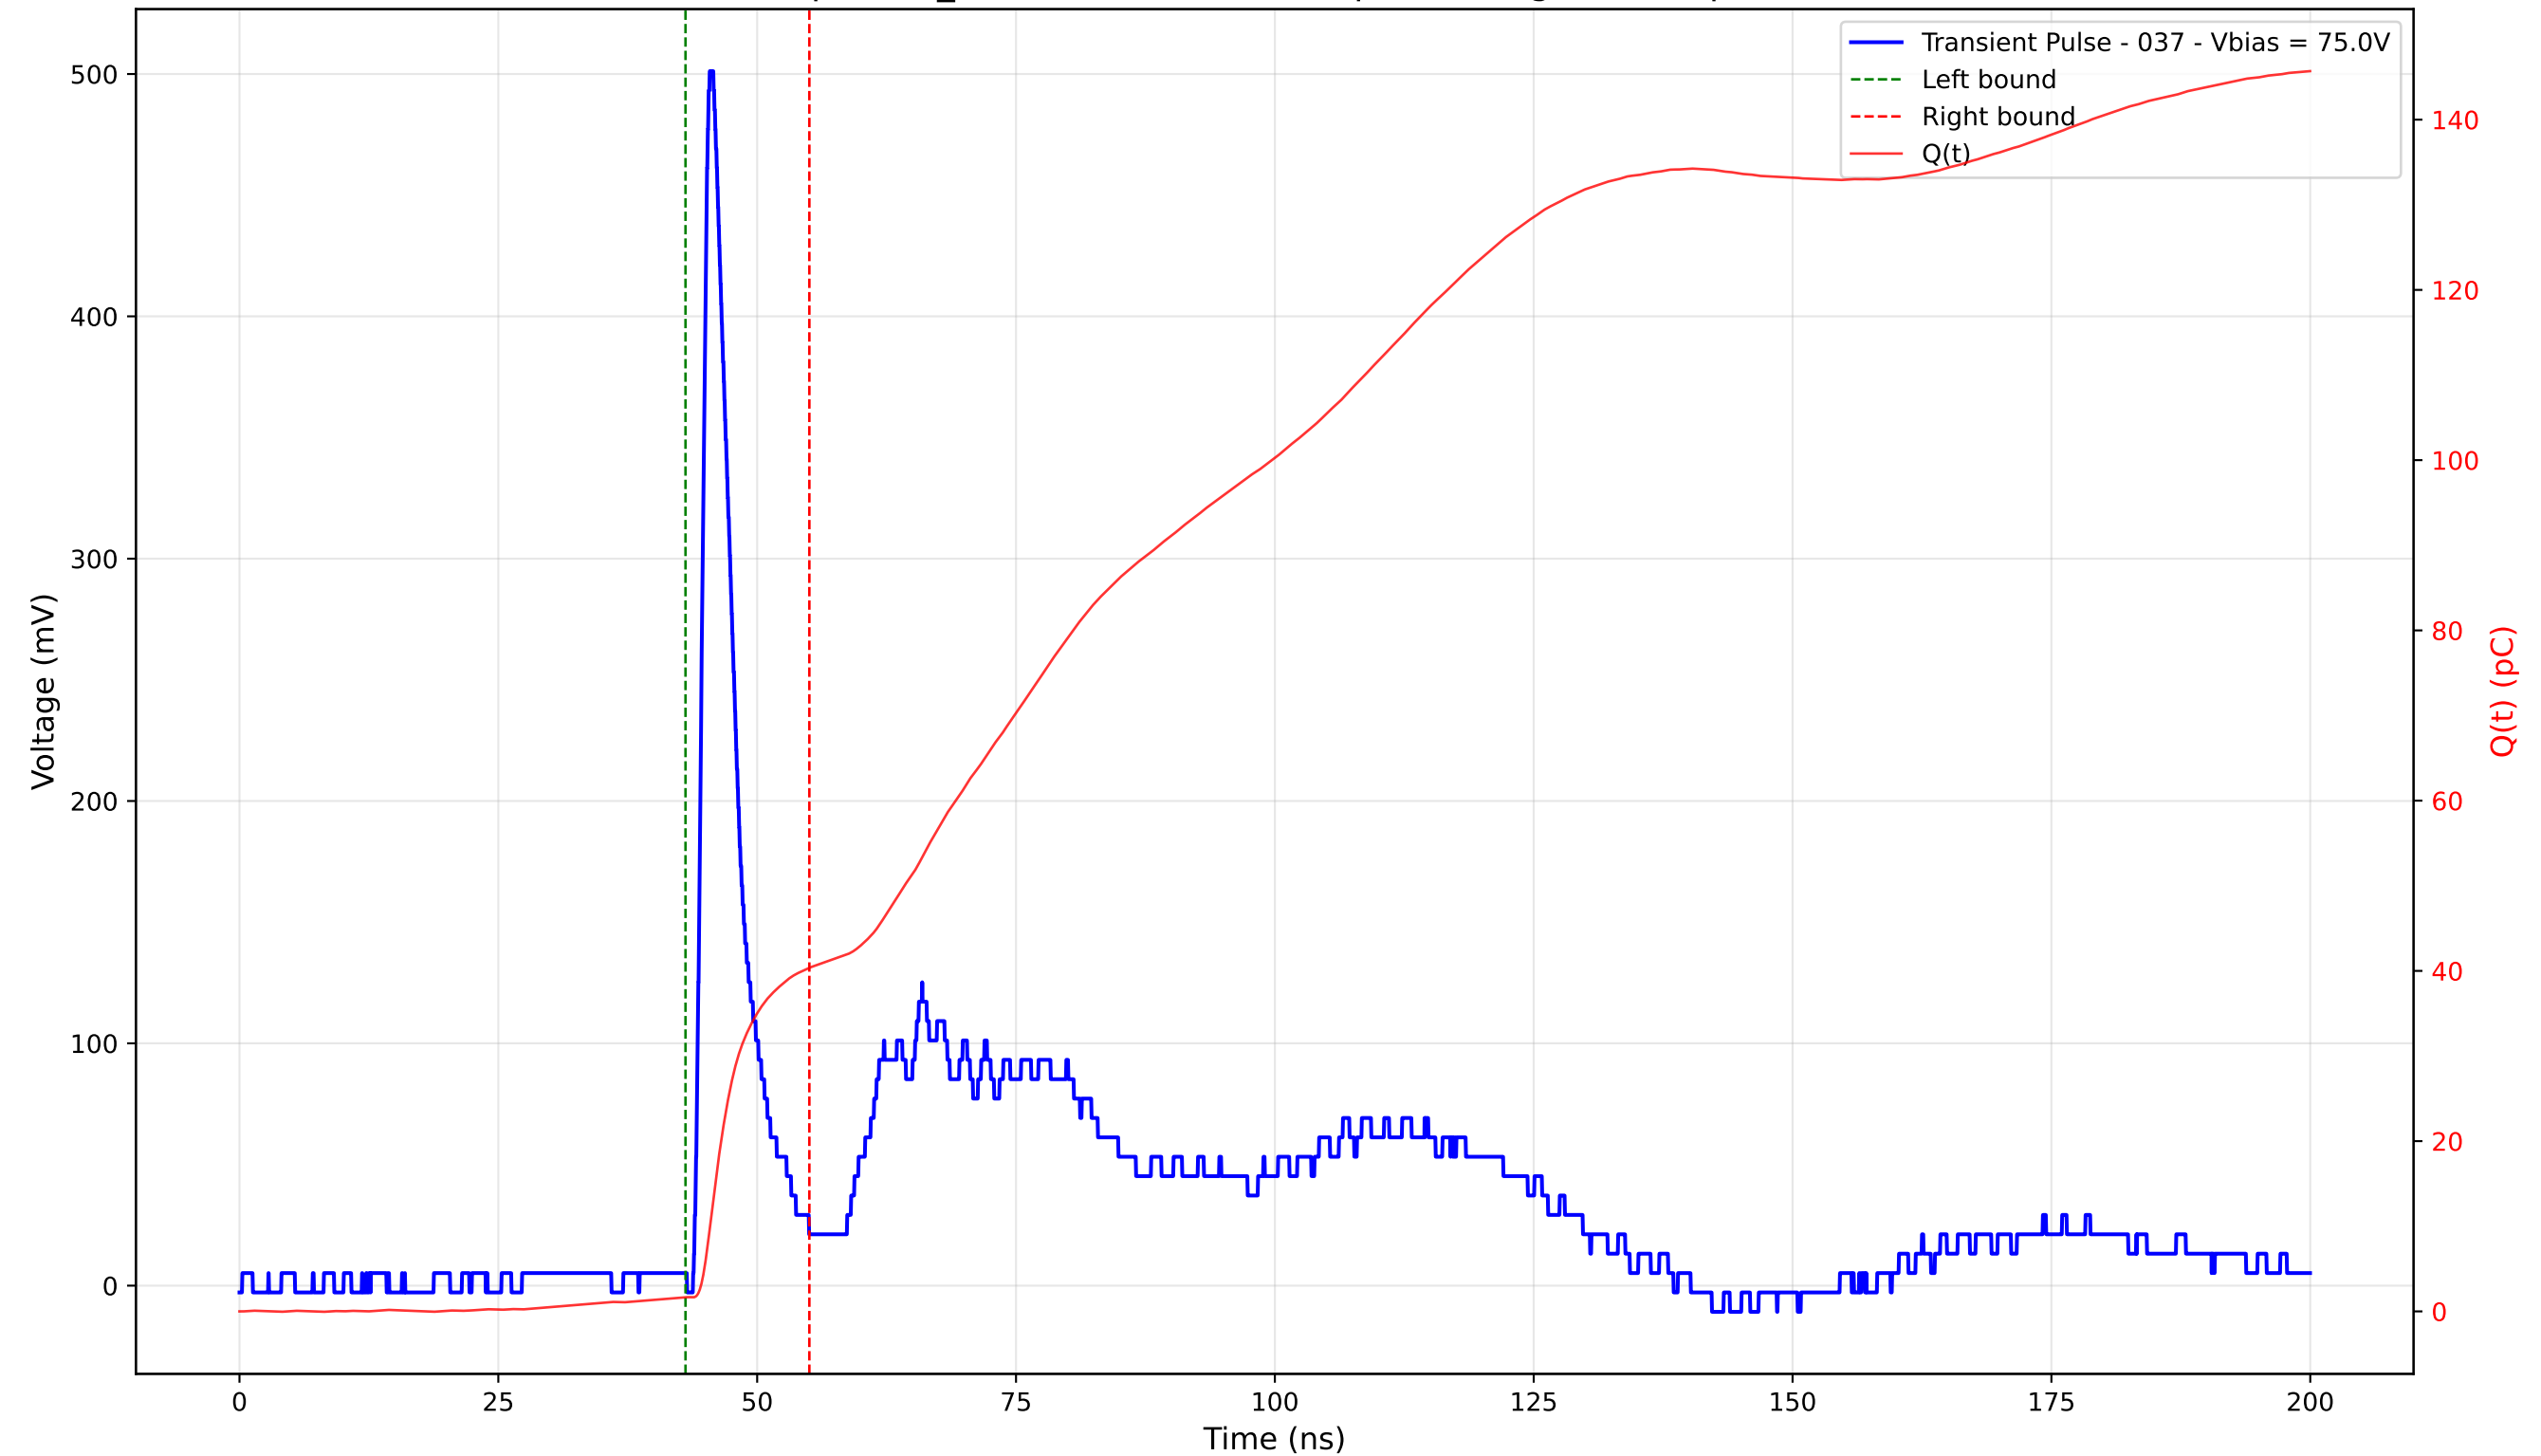


Transient Pulse - Sample: TD_4004 - Position: 230.0 μm - Charge: 33.81 pC - Rise Time: 1.03 ns

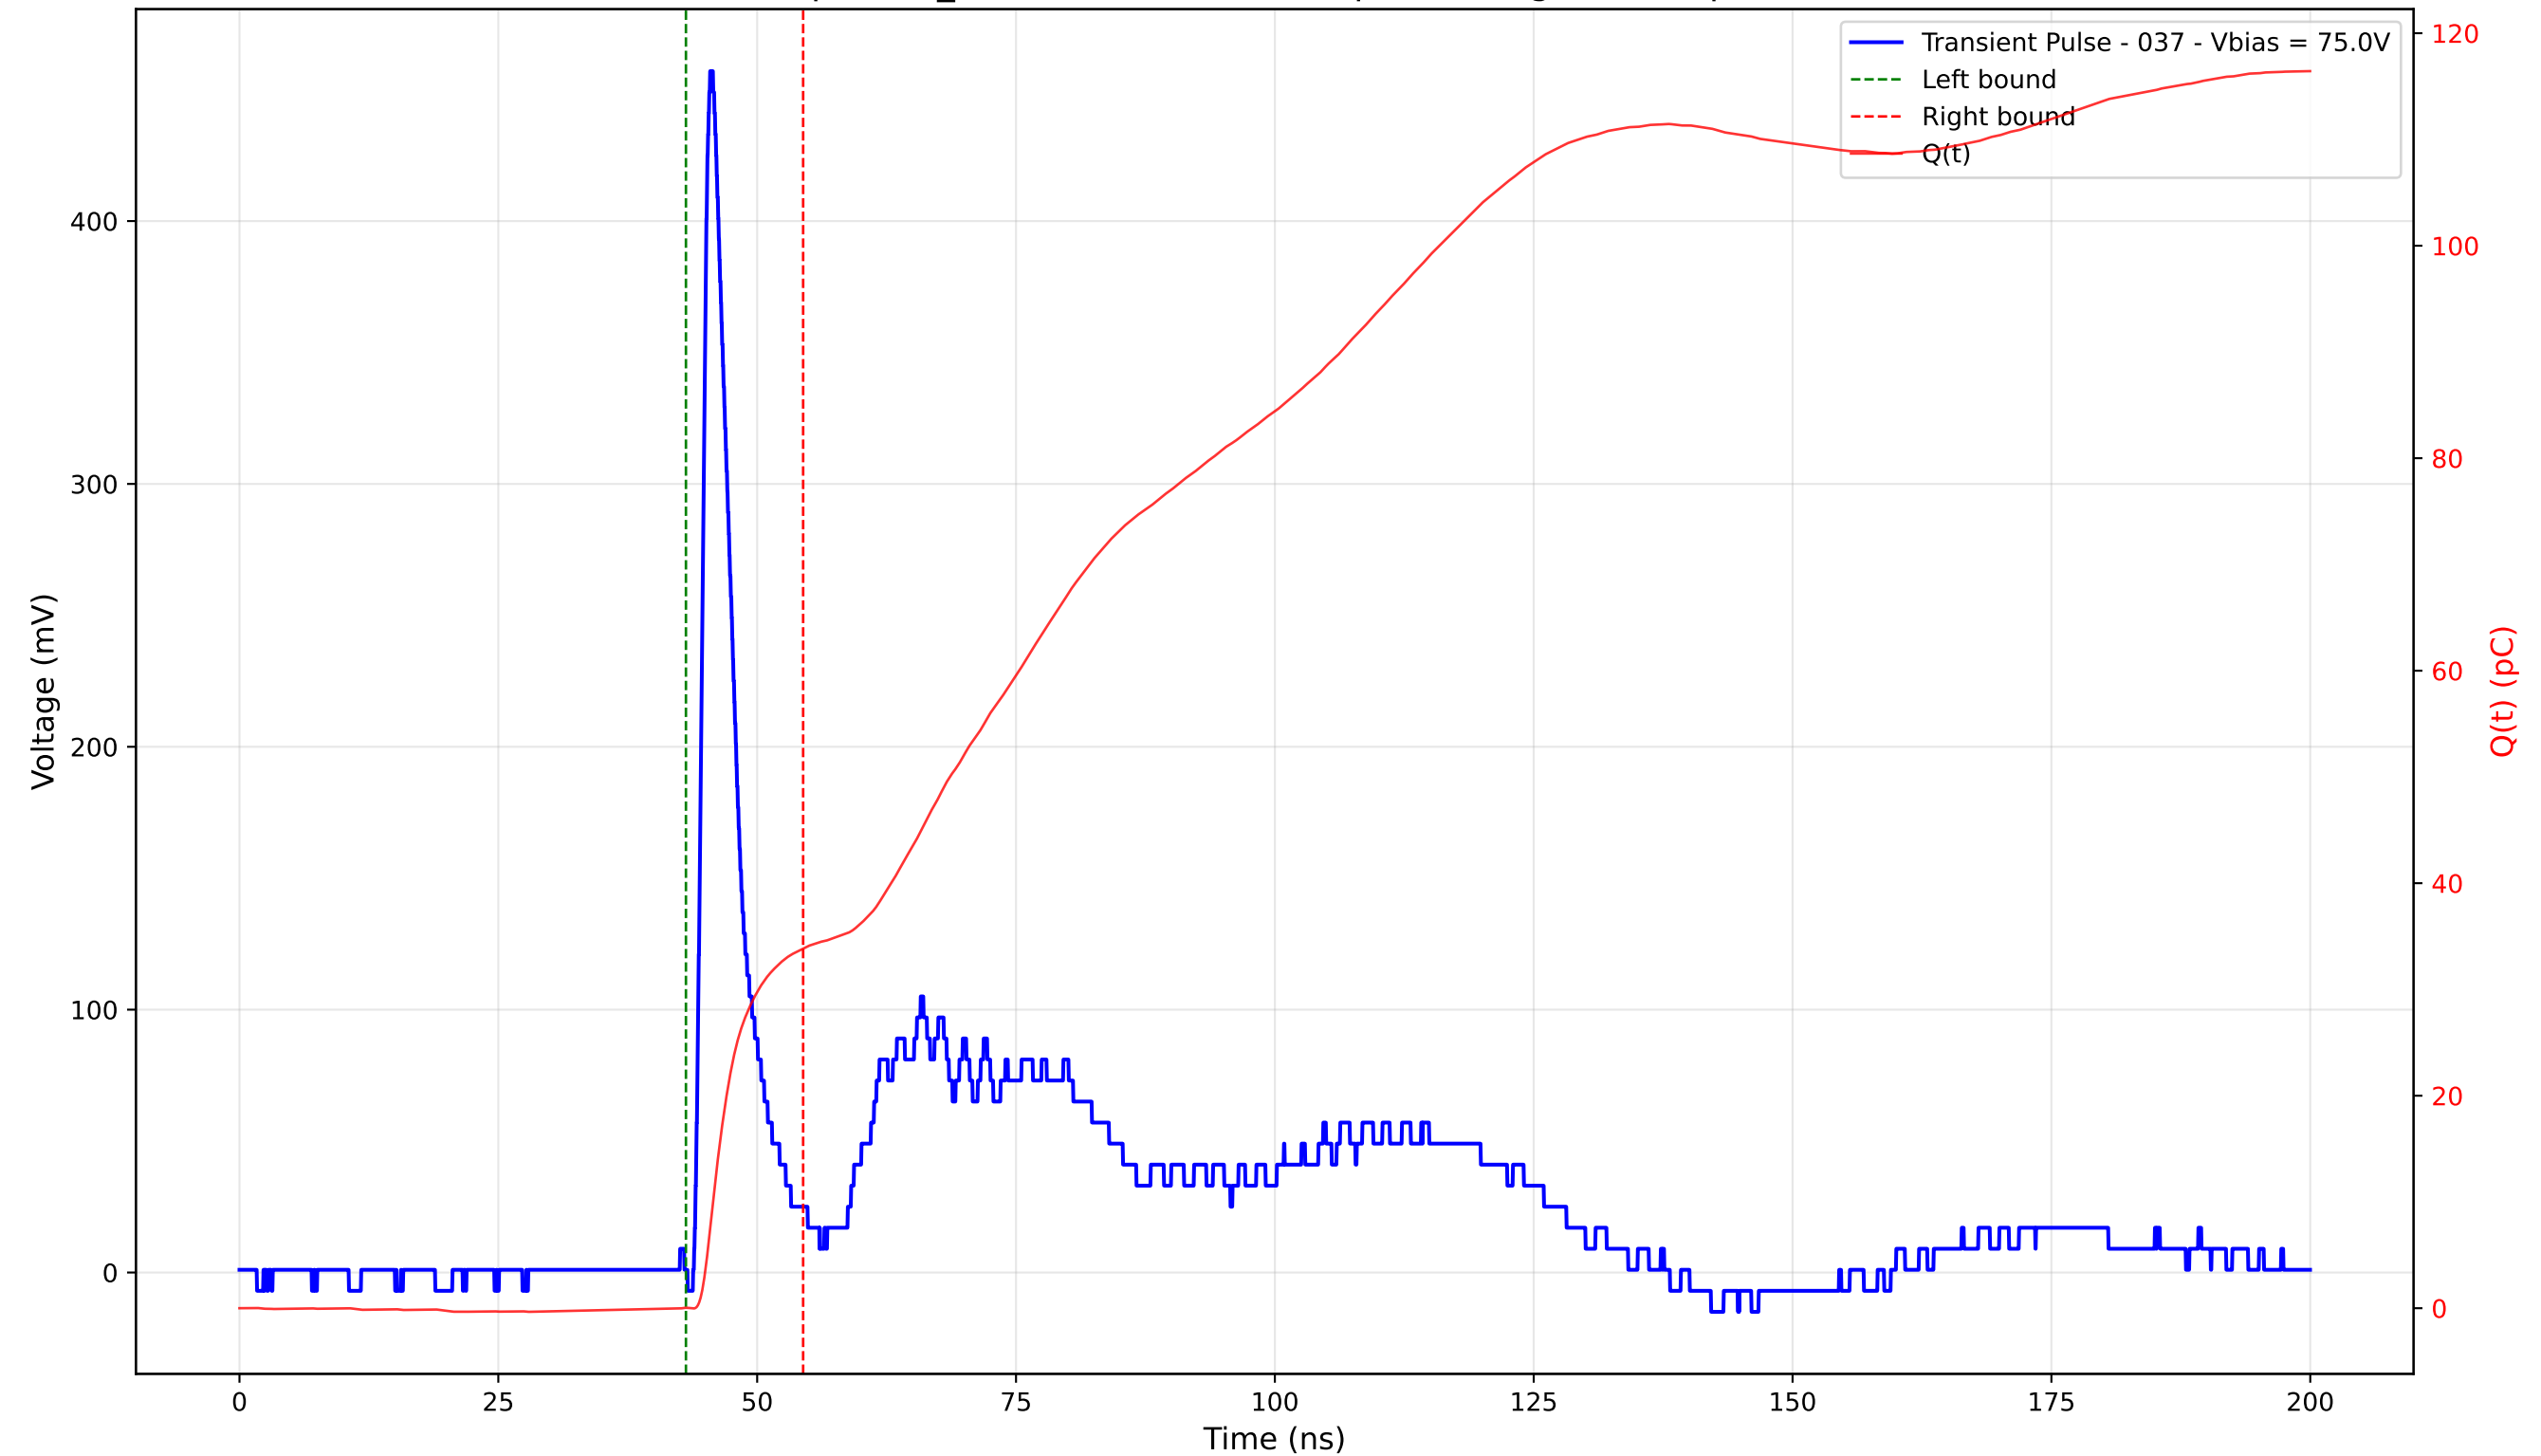


Transient Pulse - Sample: TD_4004 - Position: 235.0 μm - Charge: 30.65 pC - Rise Time: 1.08 ns

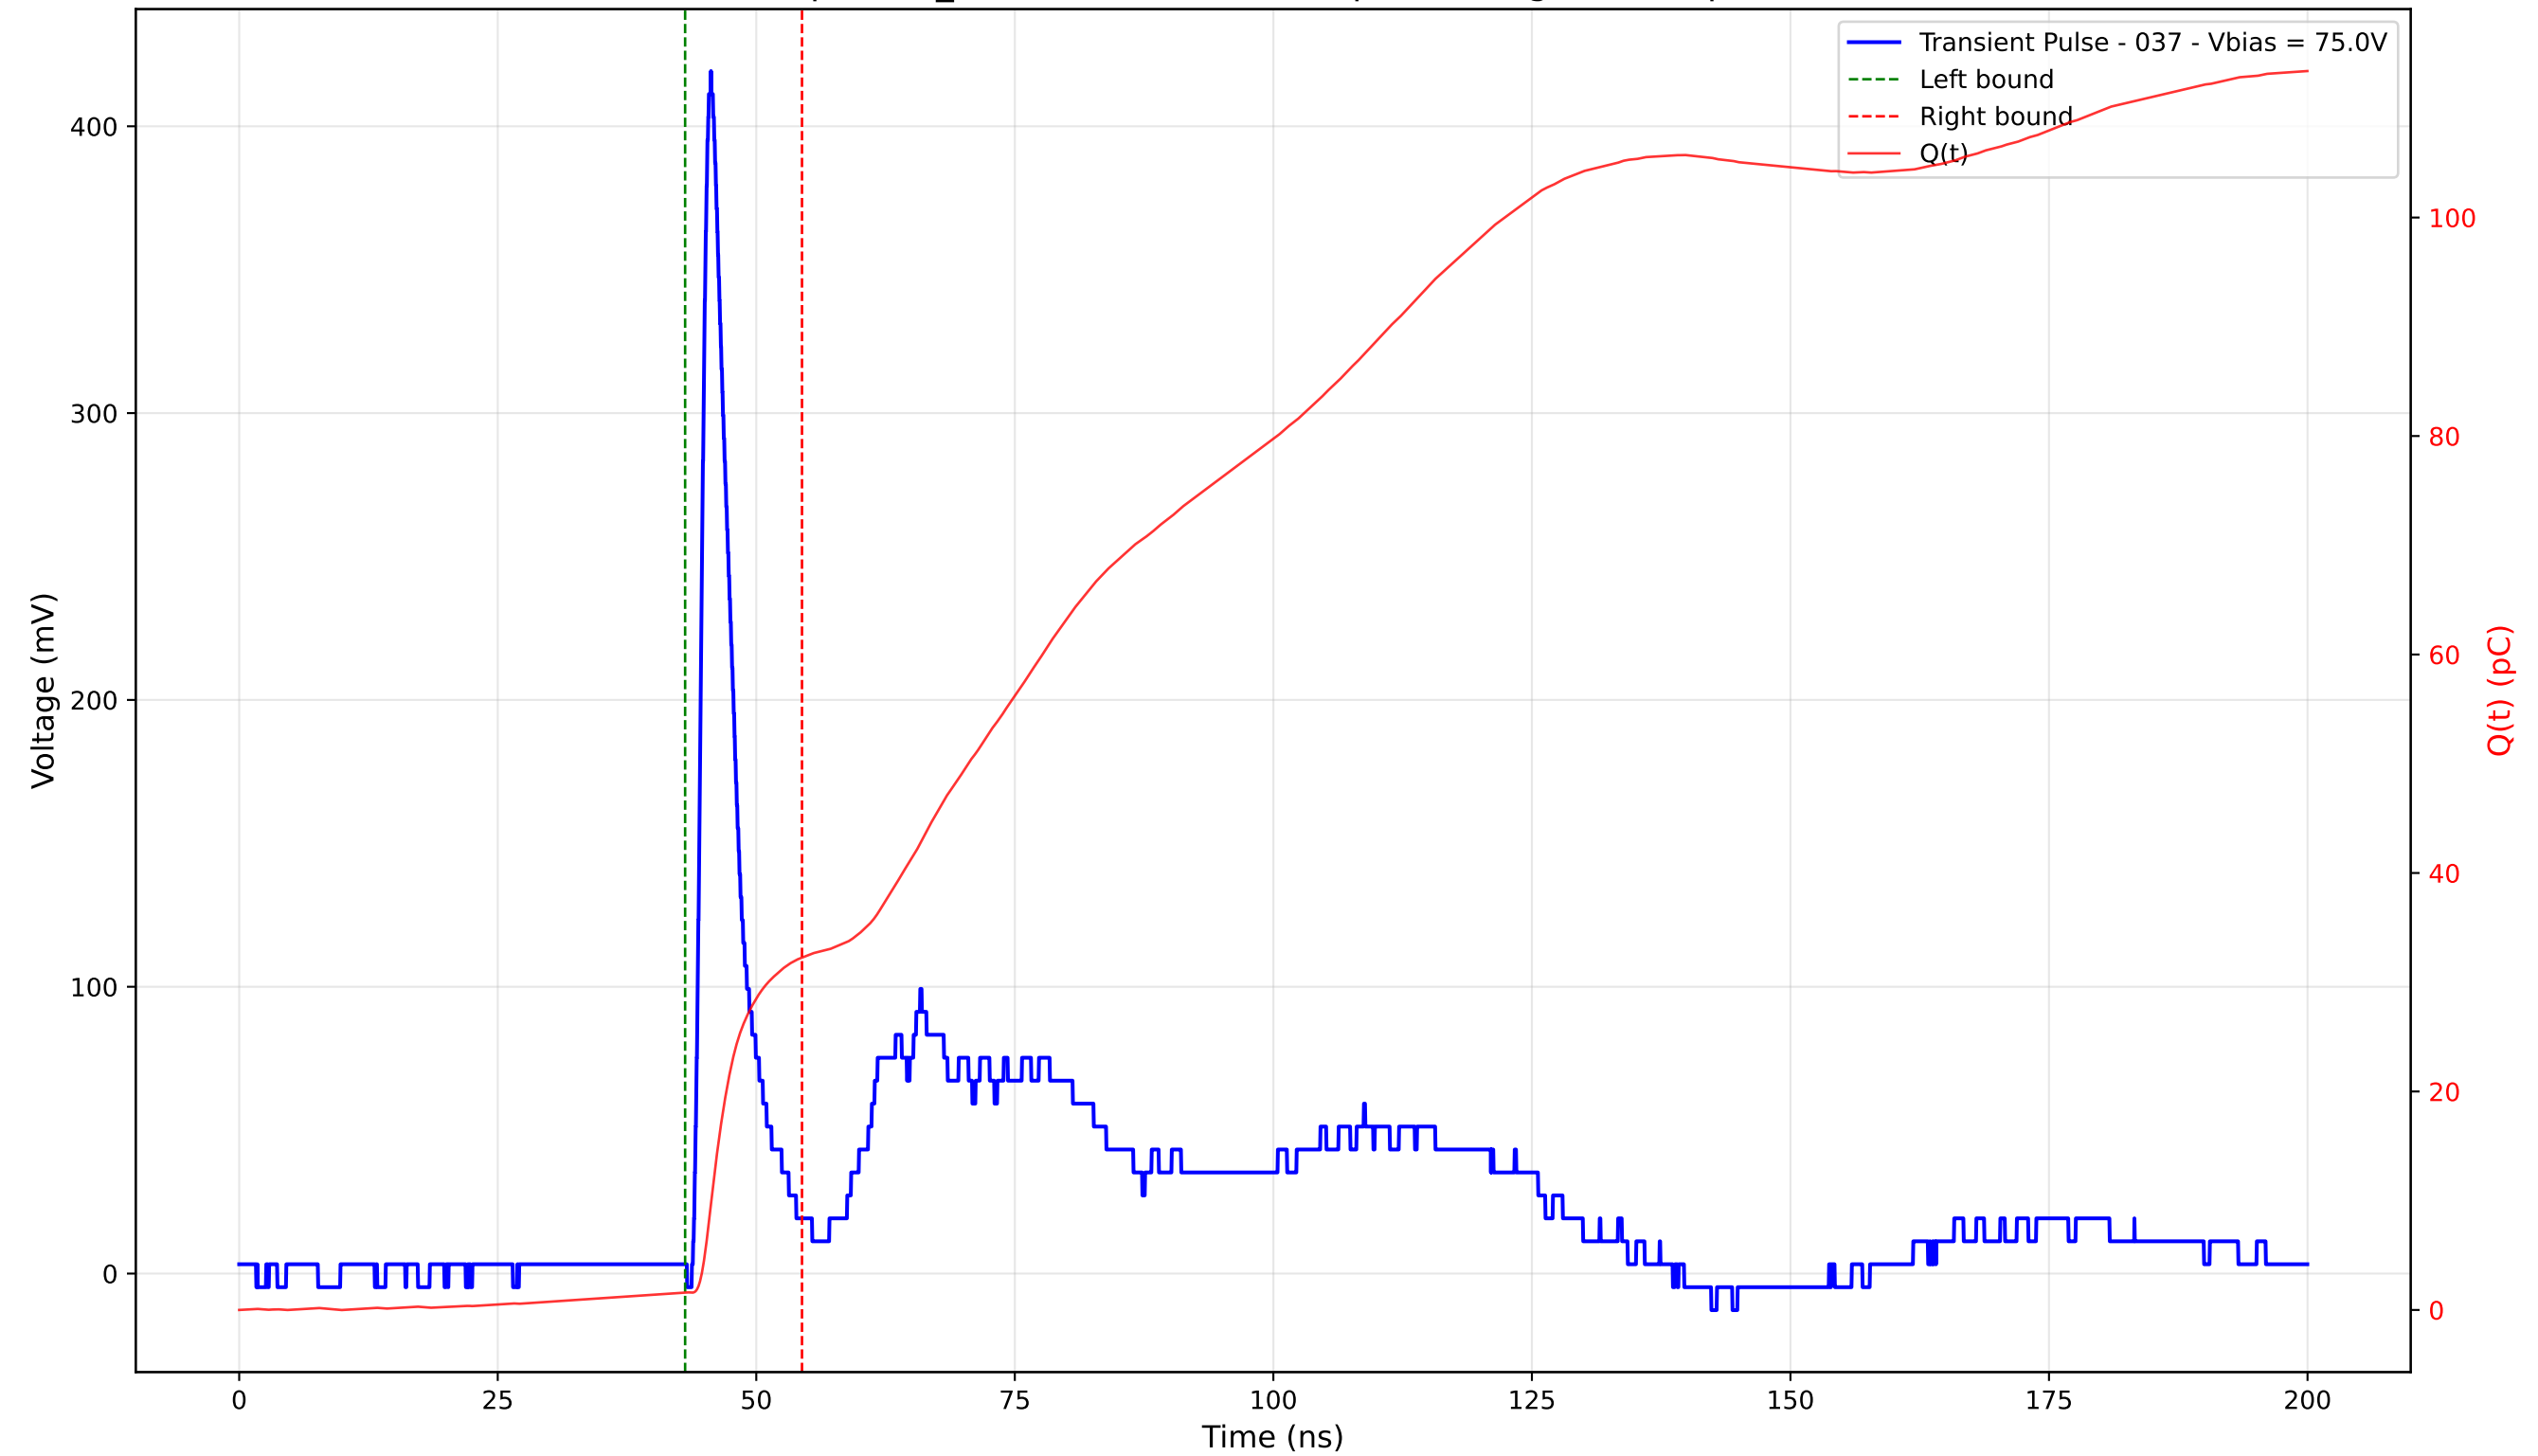


Transient Pulse - Sample: TD_4004 - Position: 240.0 μm - Charge: 29.41 pC - Rise Time: 1.07 ns

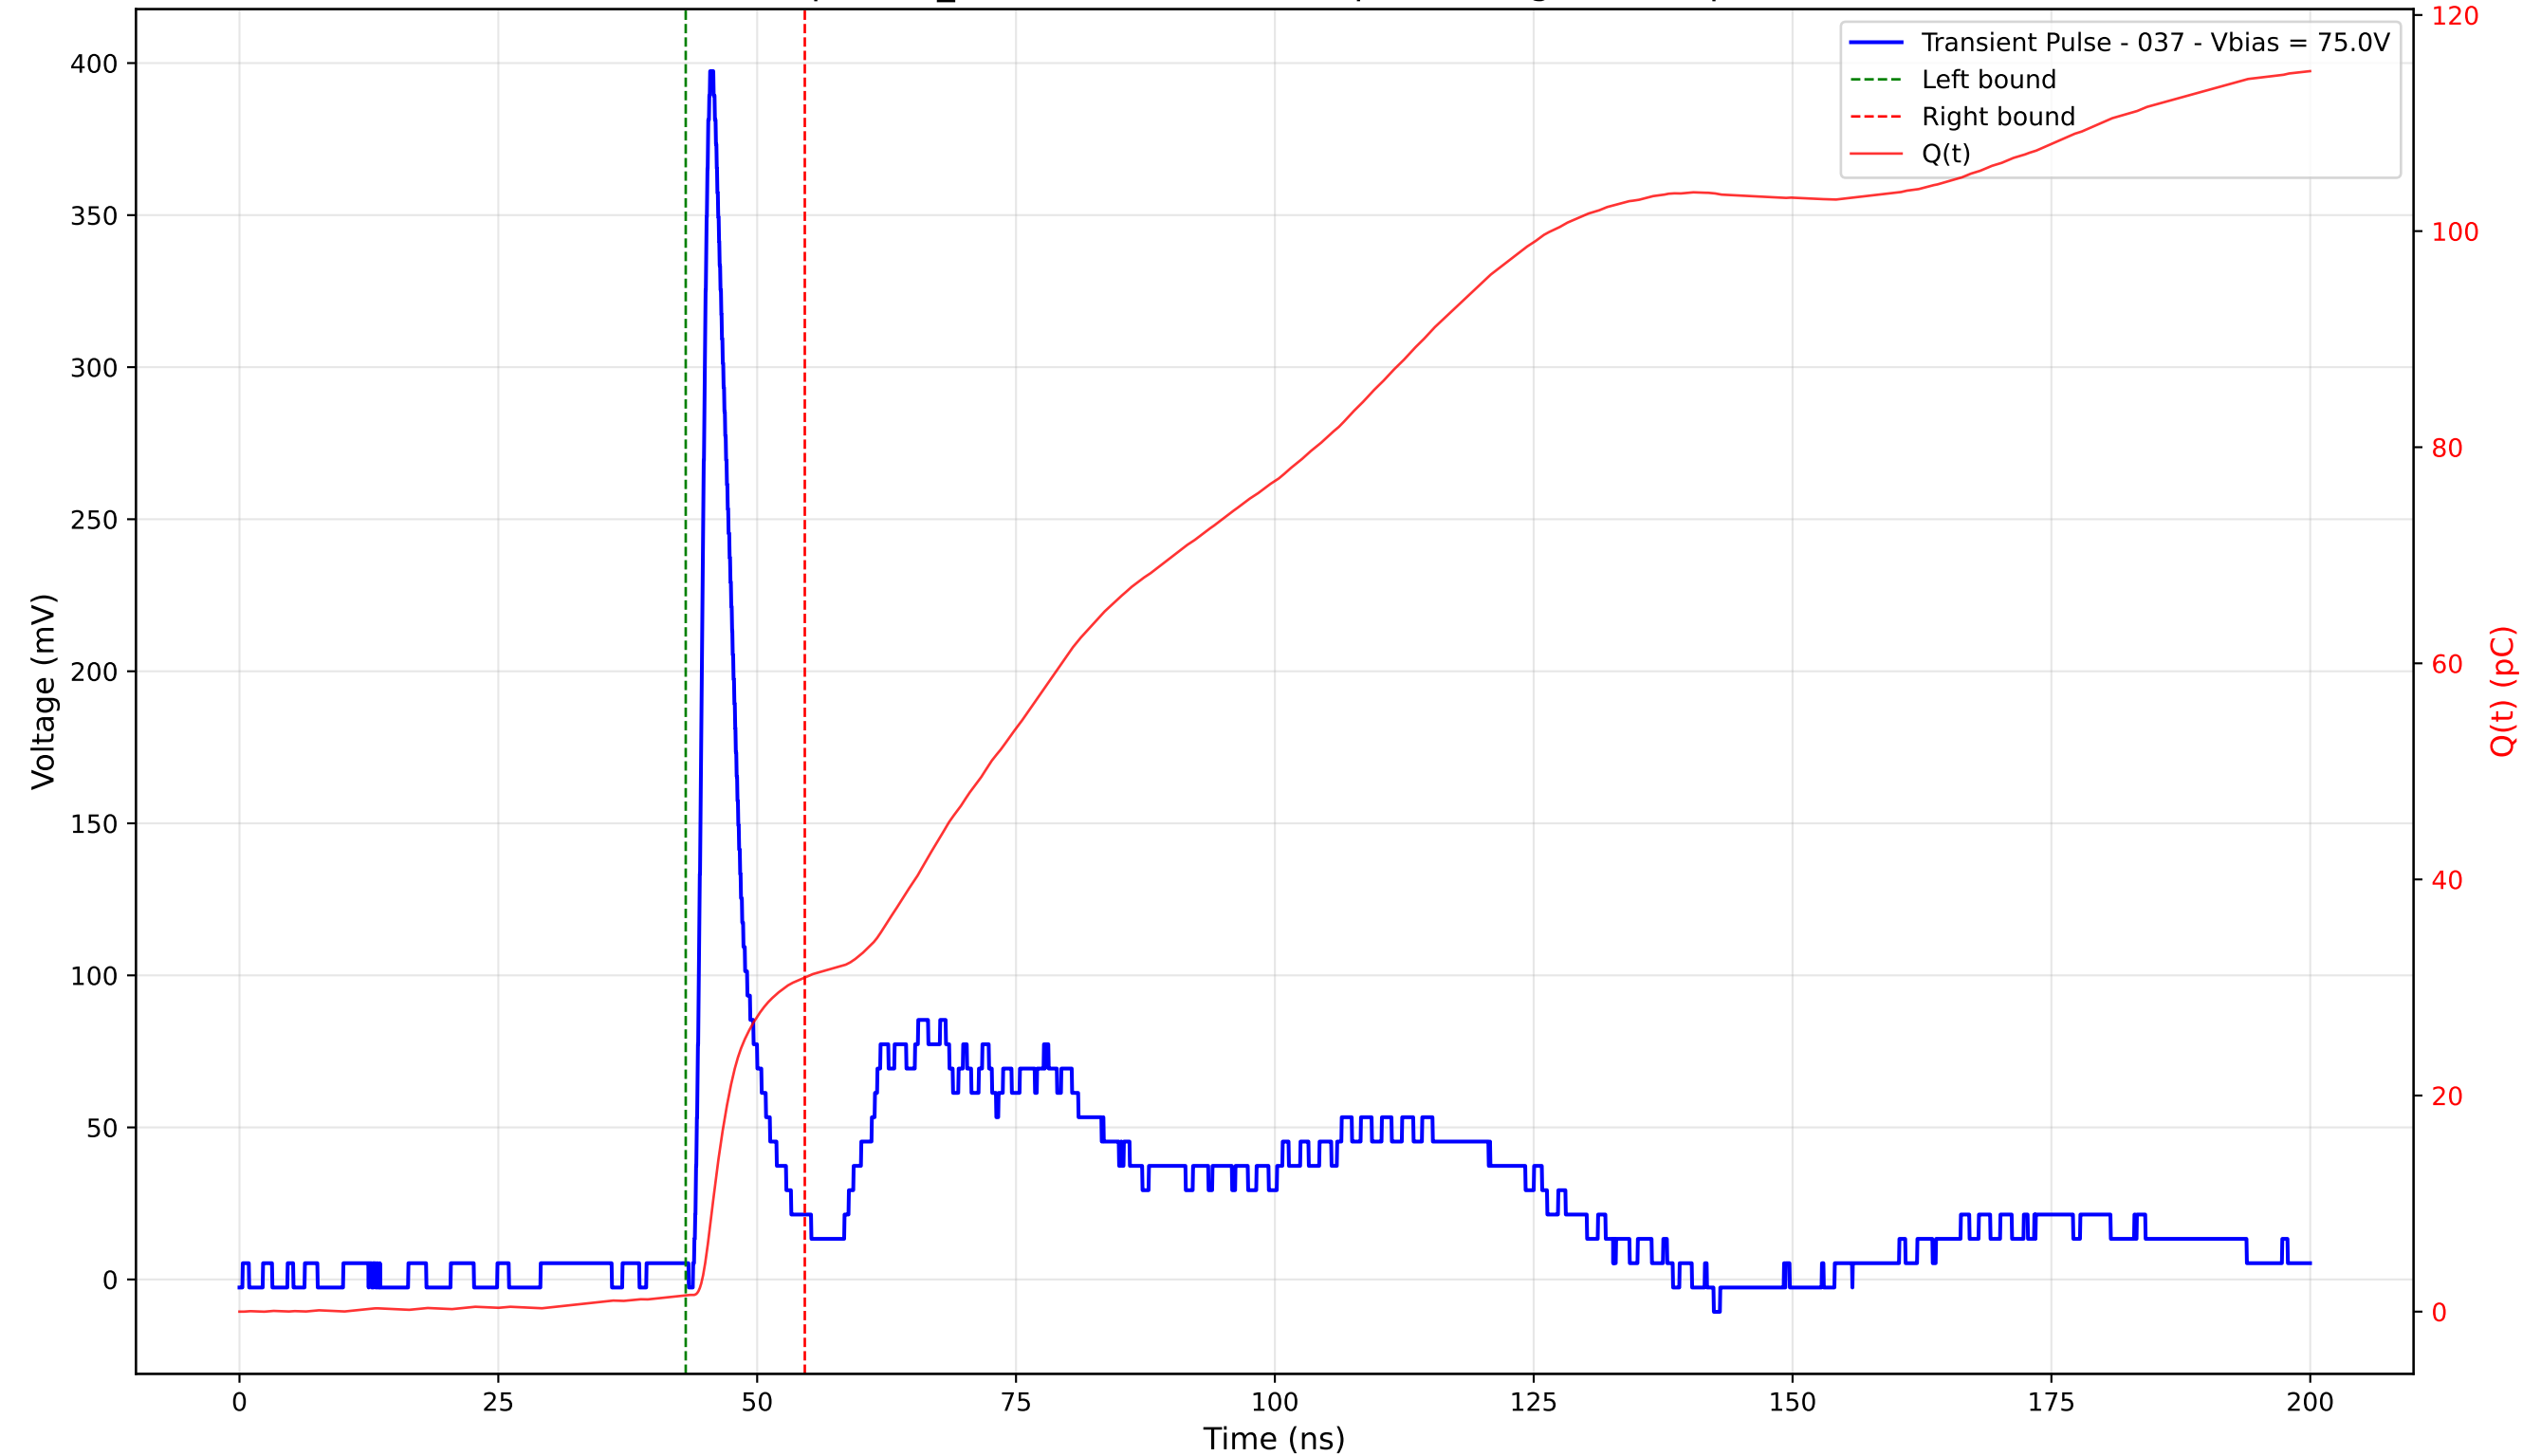


Transient Pulse - Sample: TD_4004 - Position: 245.0 μm - Charge: 27.56 pC - Rise Time: 1.07 ns

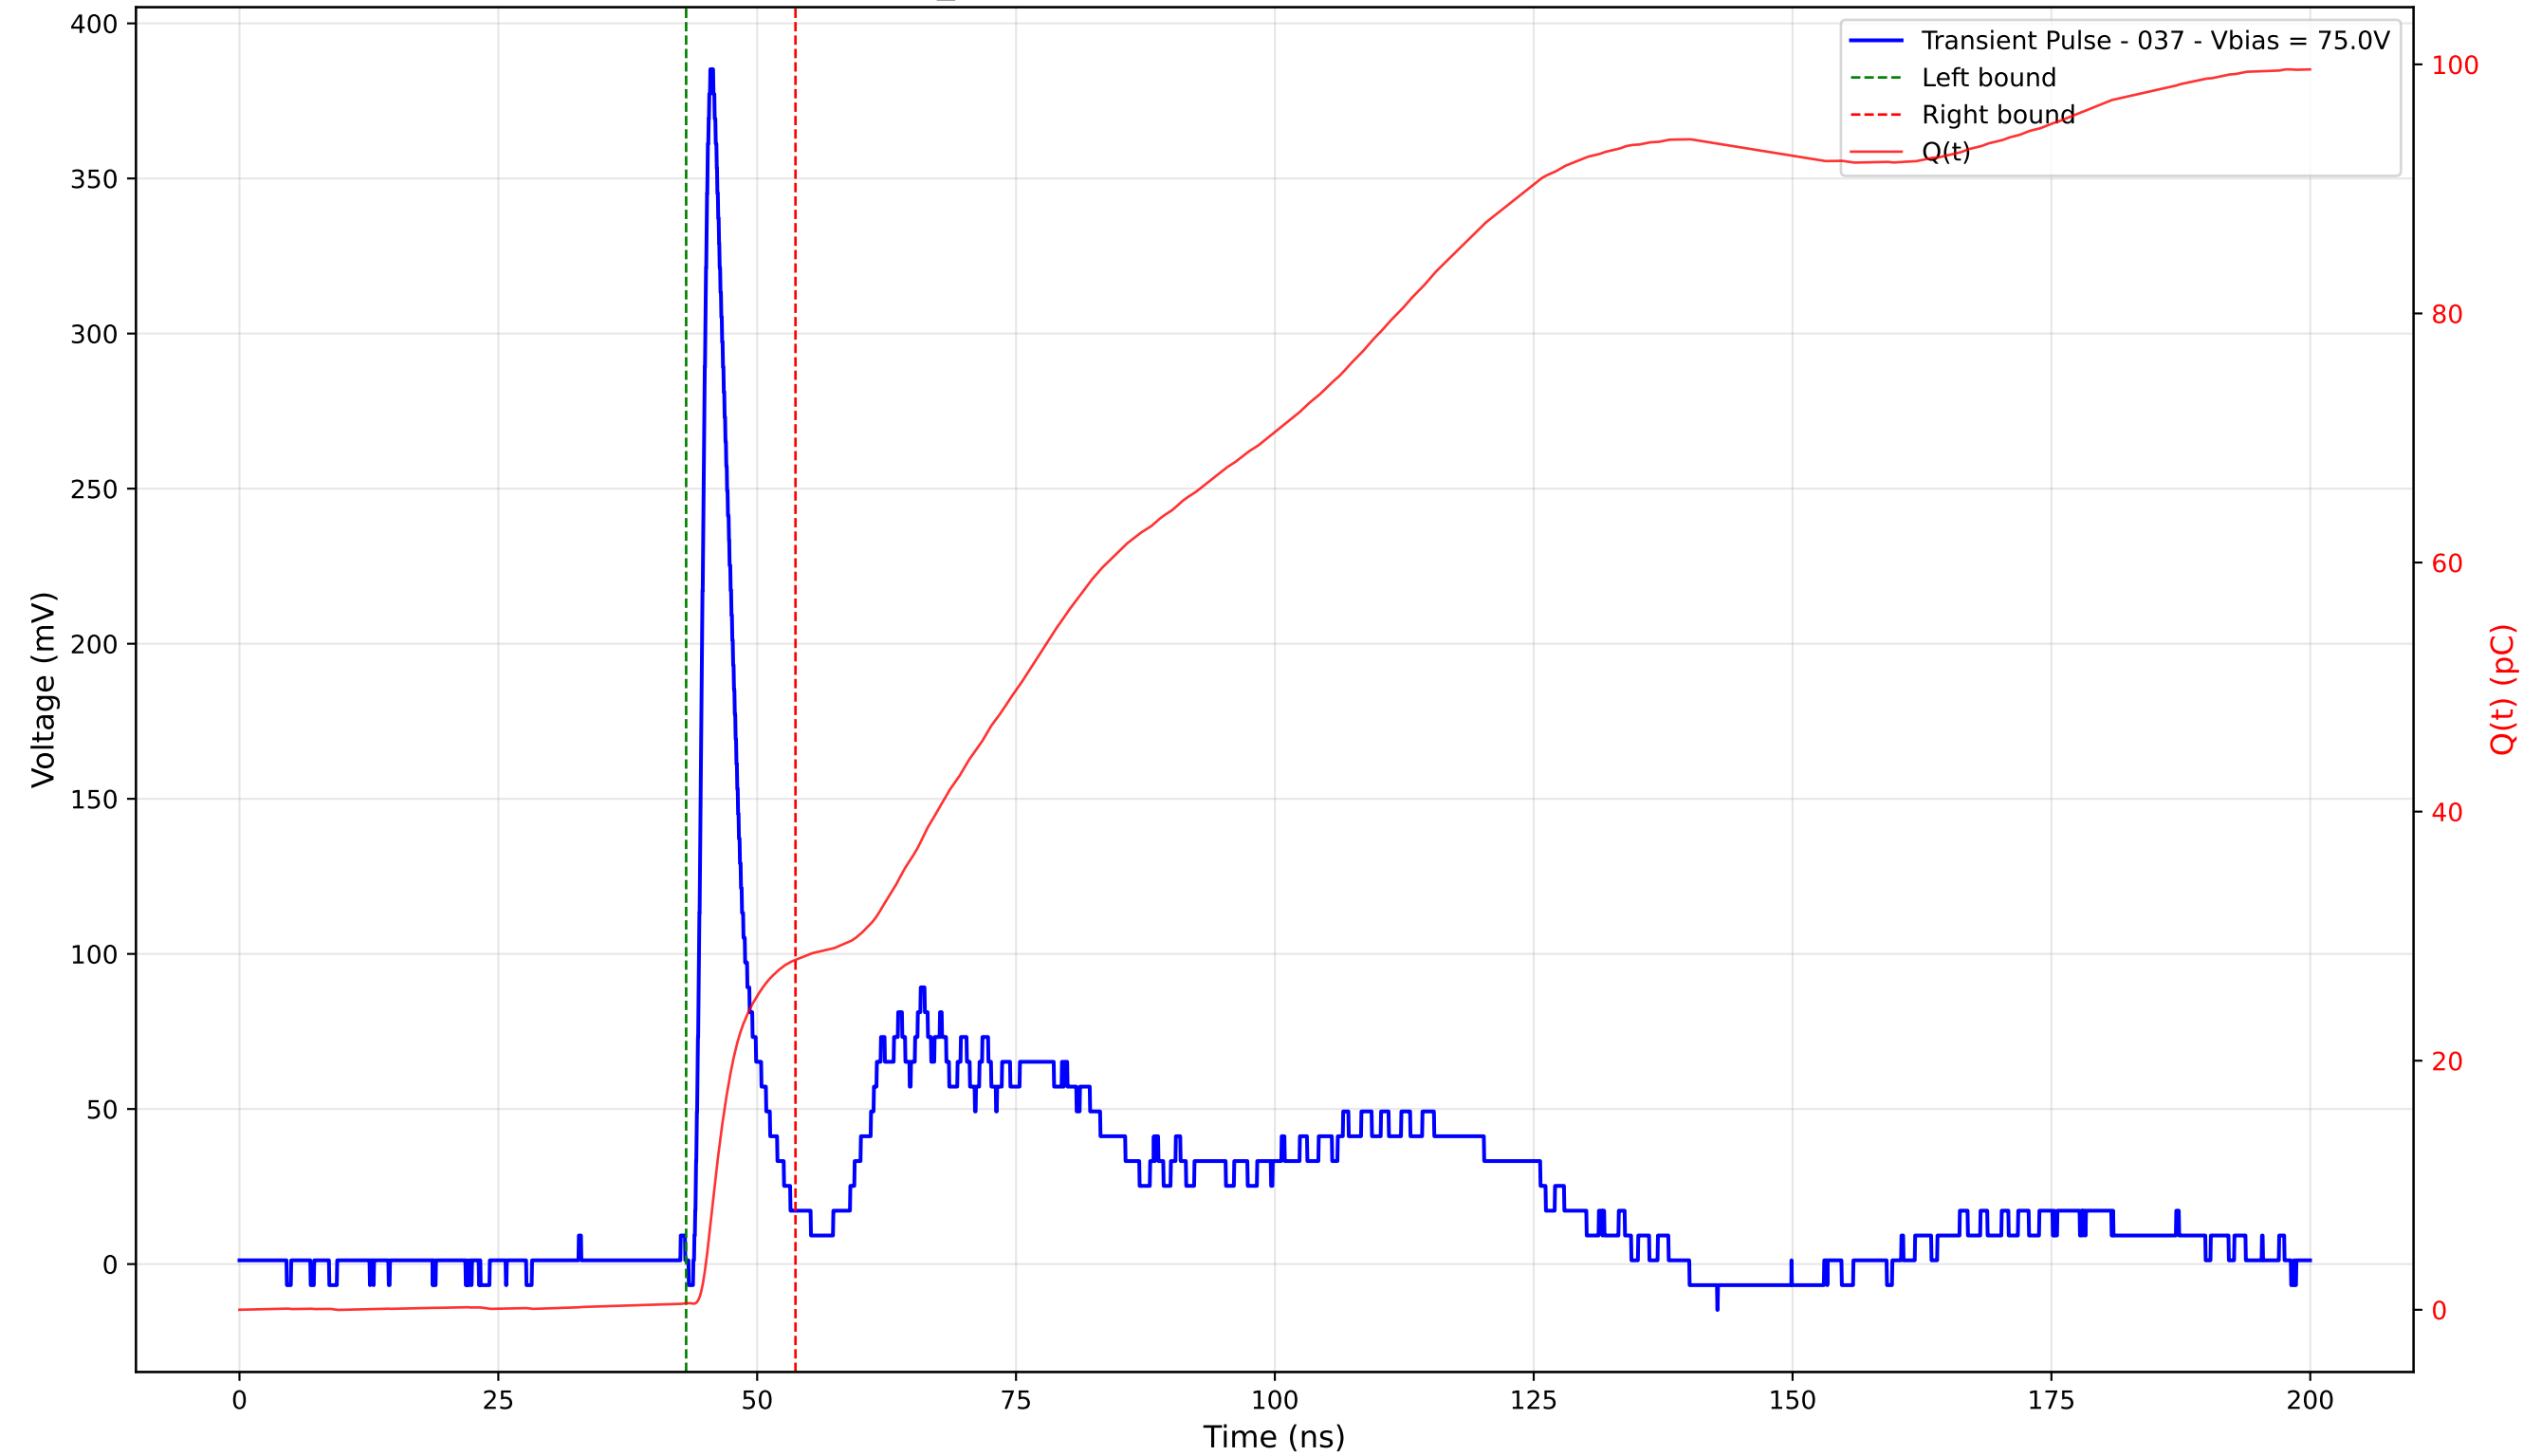


Transient Pulse - Sample: TD_4004 - Position: 250.0 μm - Charge: 27.40 pC - Rise Time: 1.05 ns

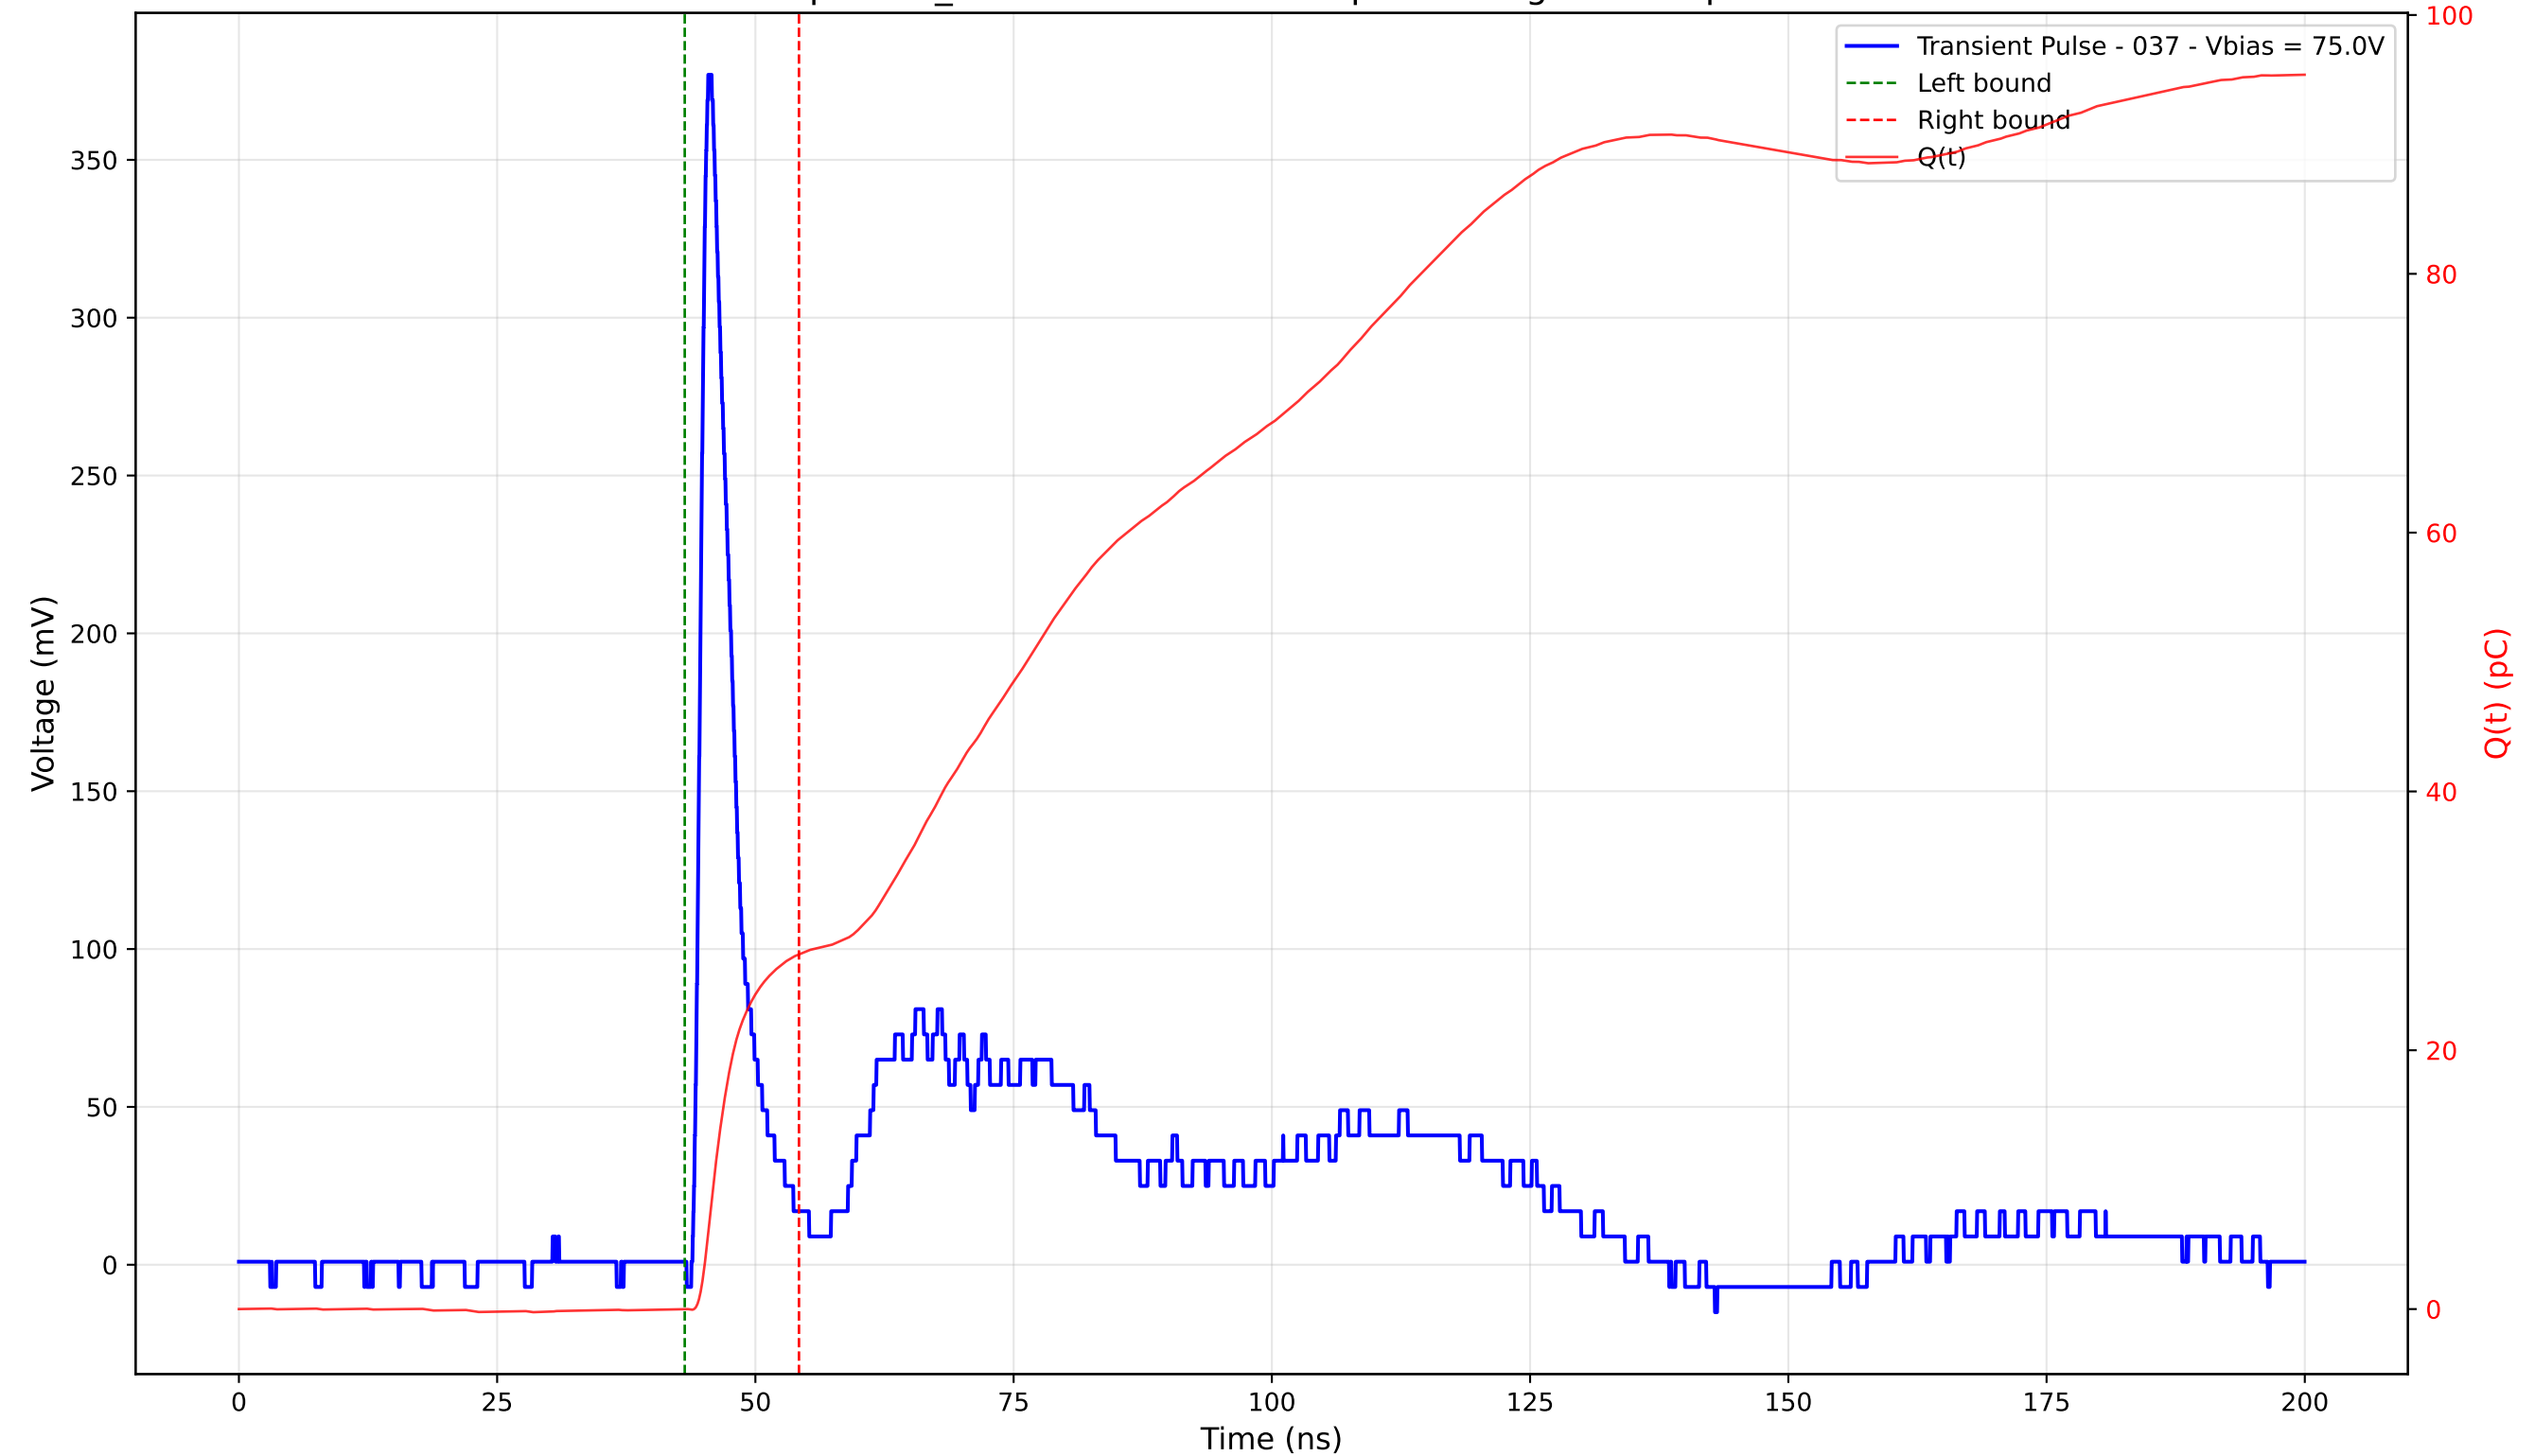


Transient Pulse - Sample: TD_4004 - Position: 255.0 μm - Charge: 27.33 pC - Rise Time: 1.09 ns

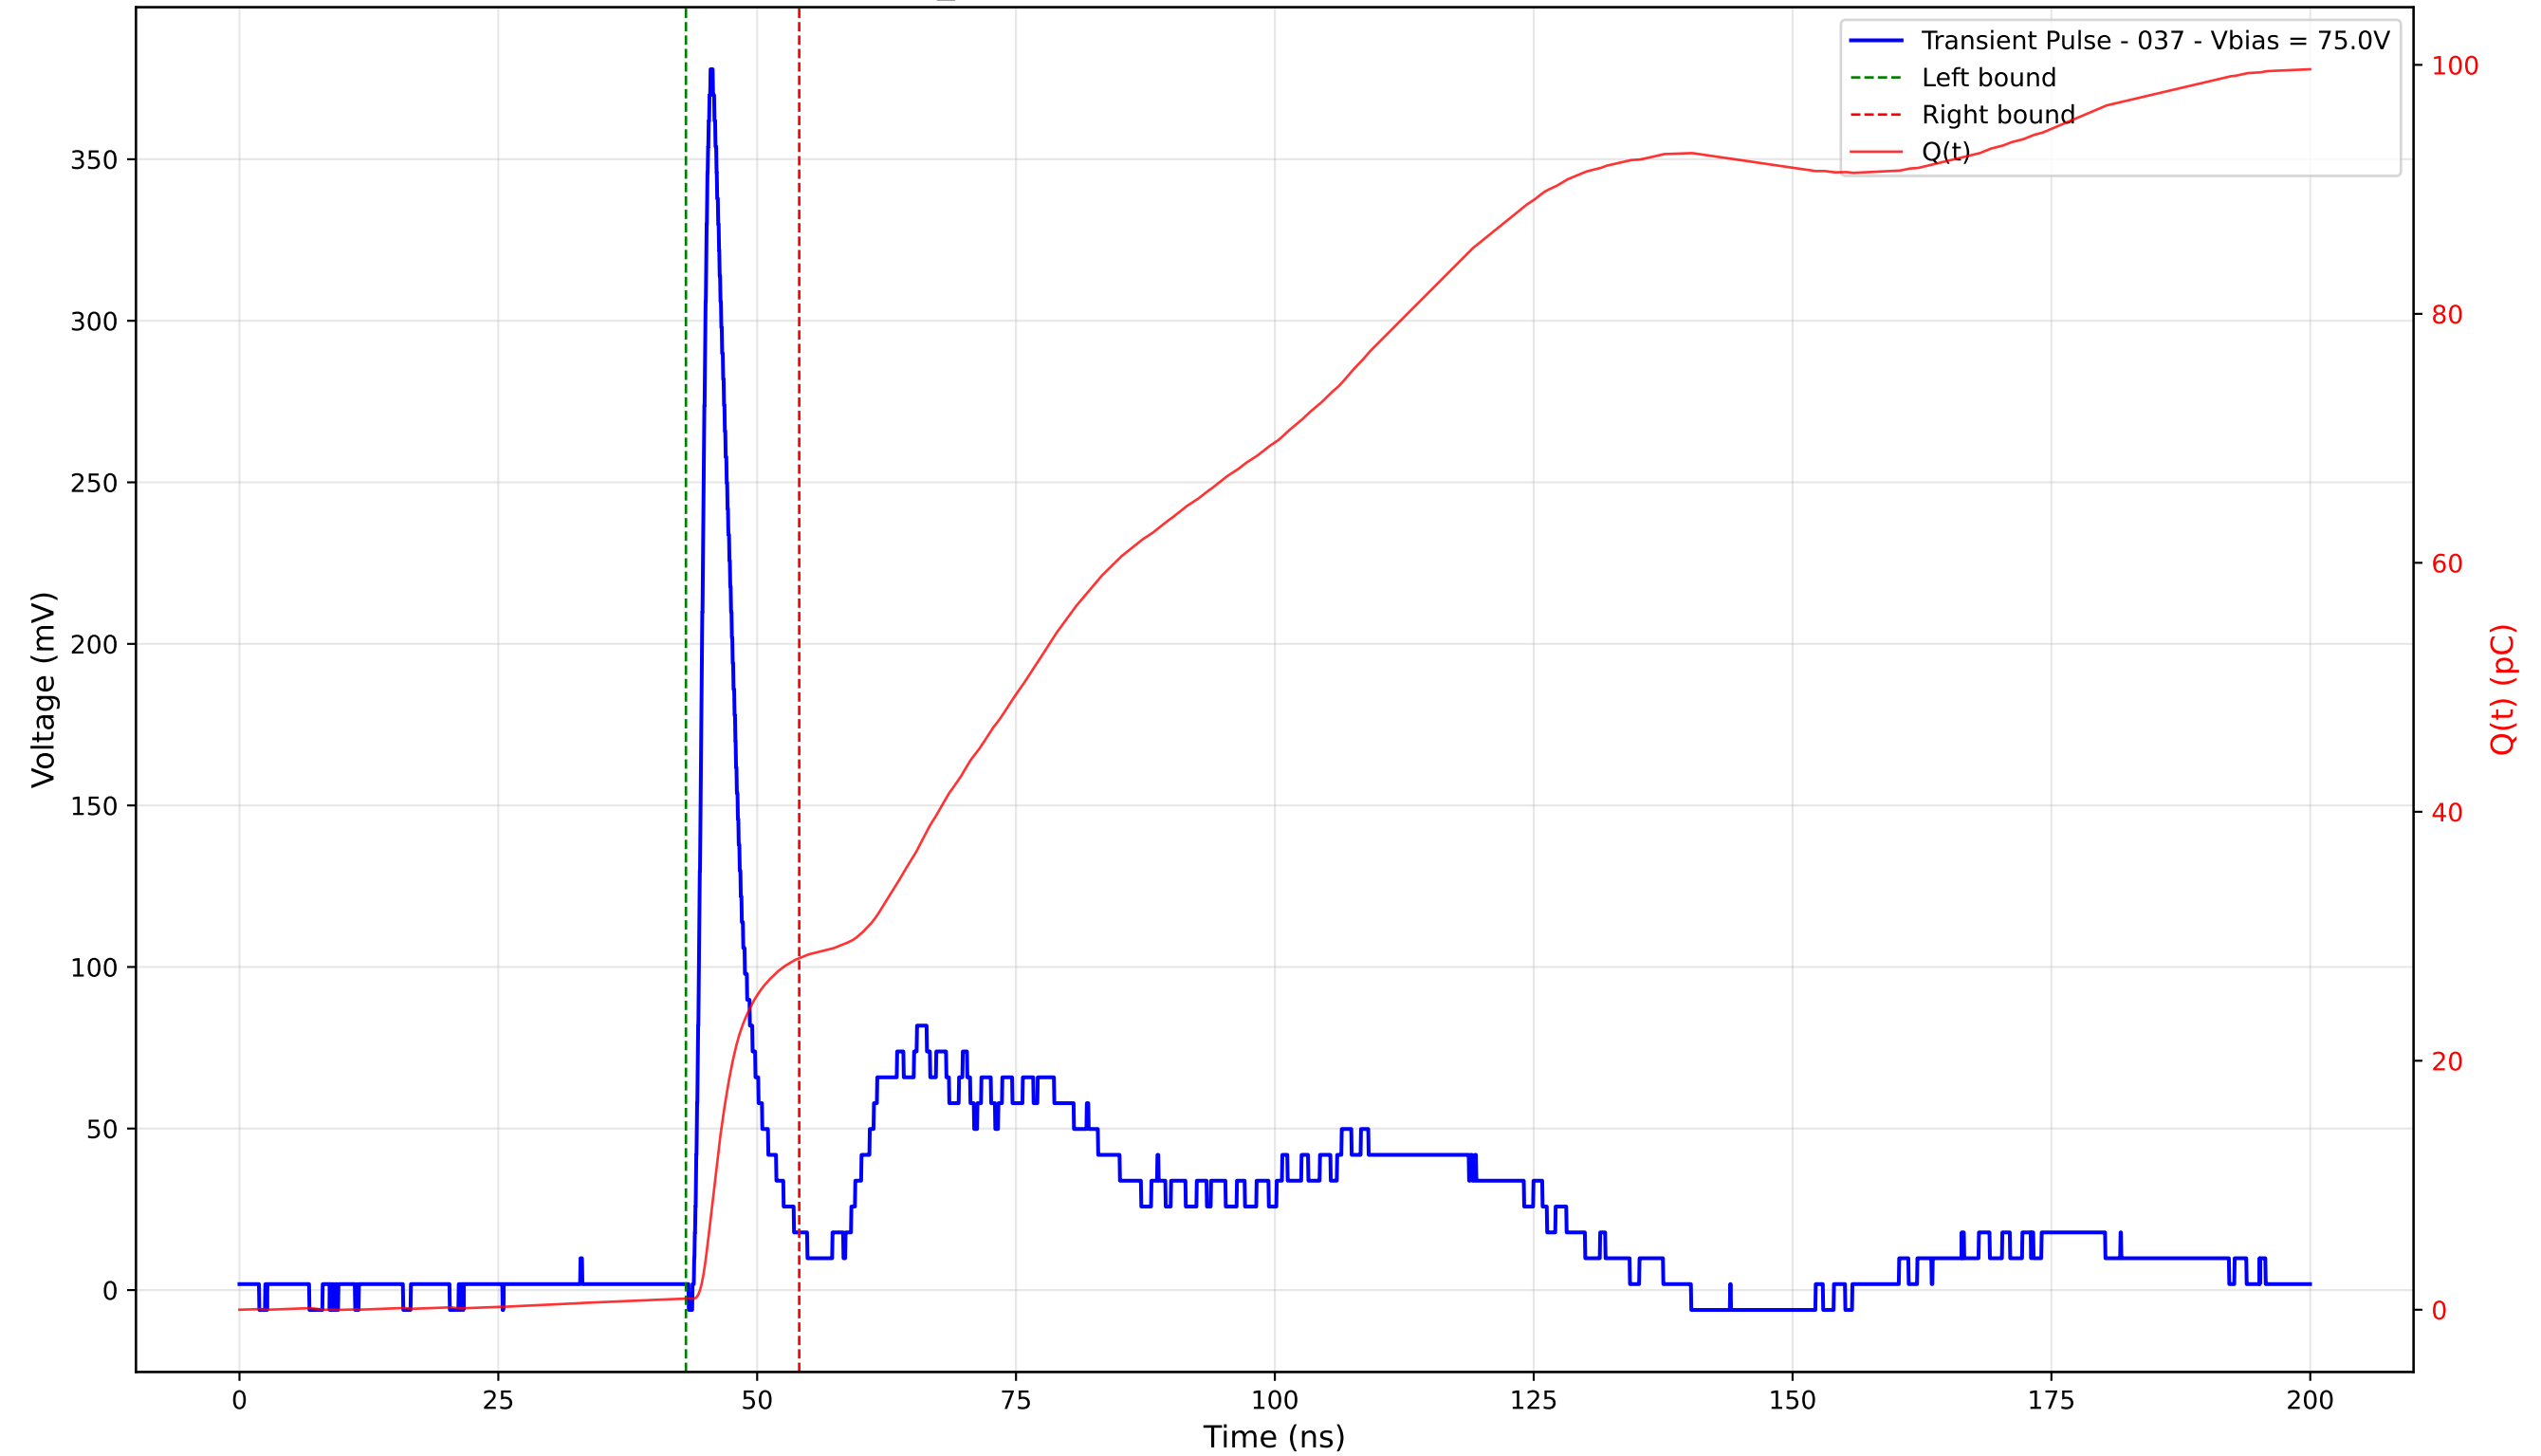


Transient Pulse - Sample: TD_4004 - Position: 260.0 μm - Charge: 25.52 pC - Rise Time: 1.08 ns

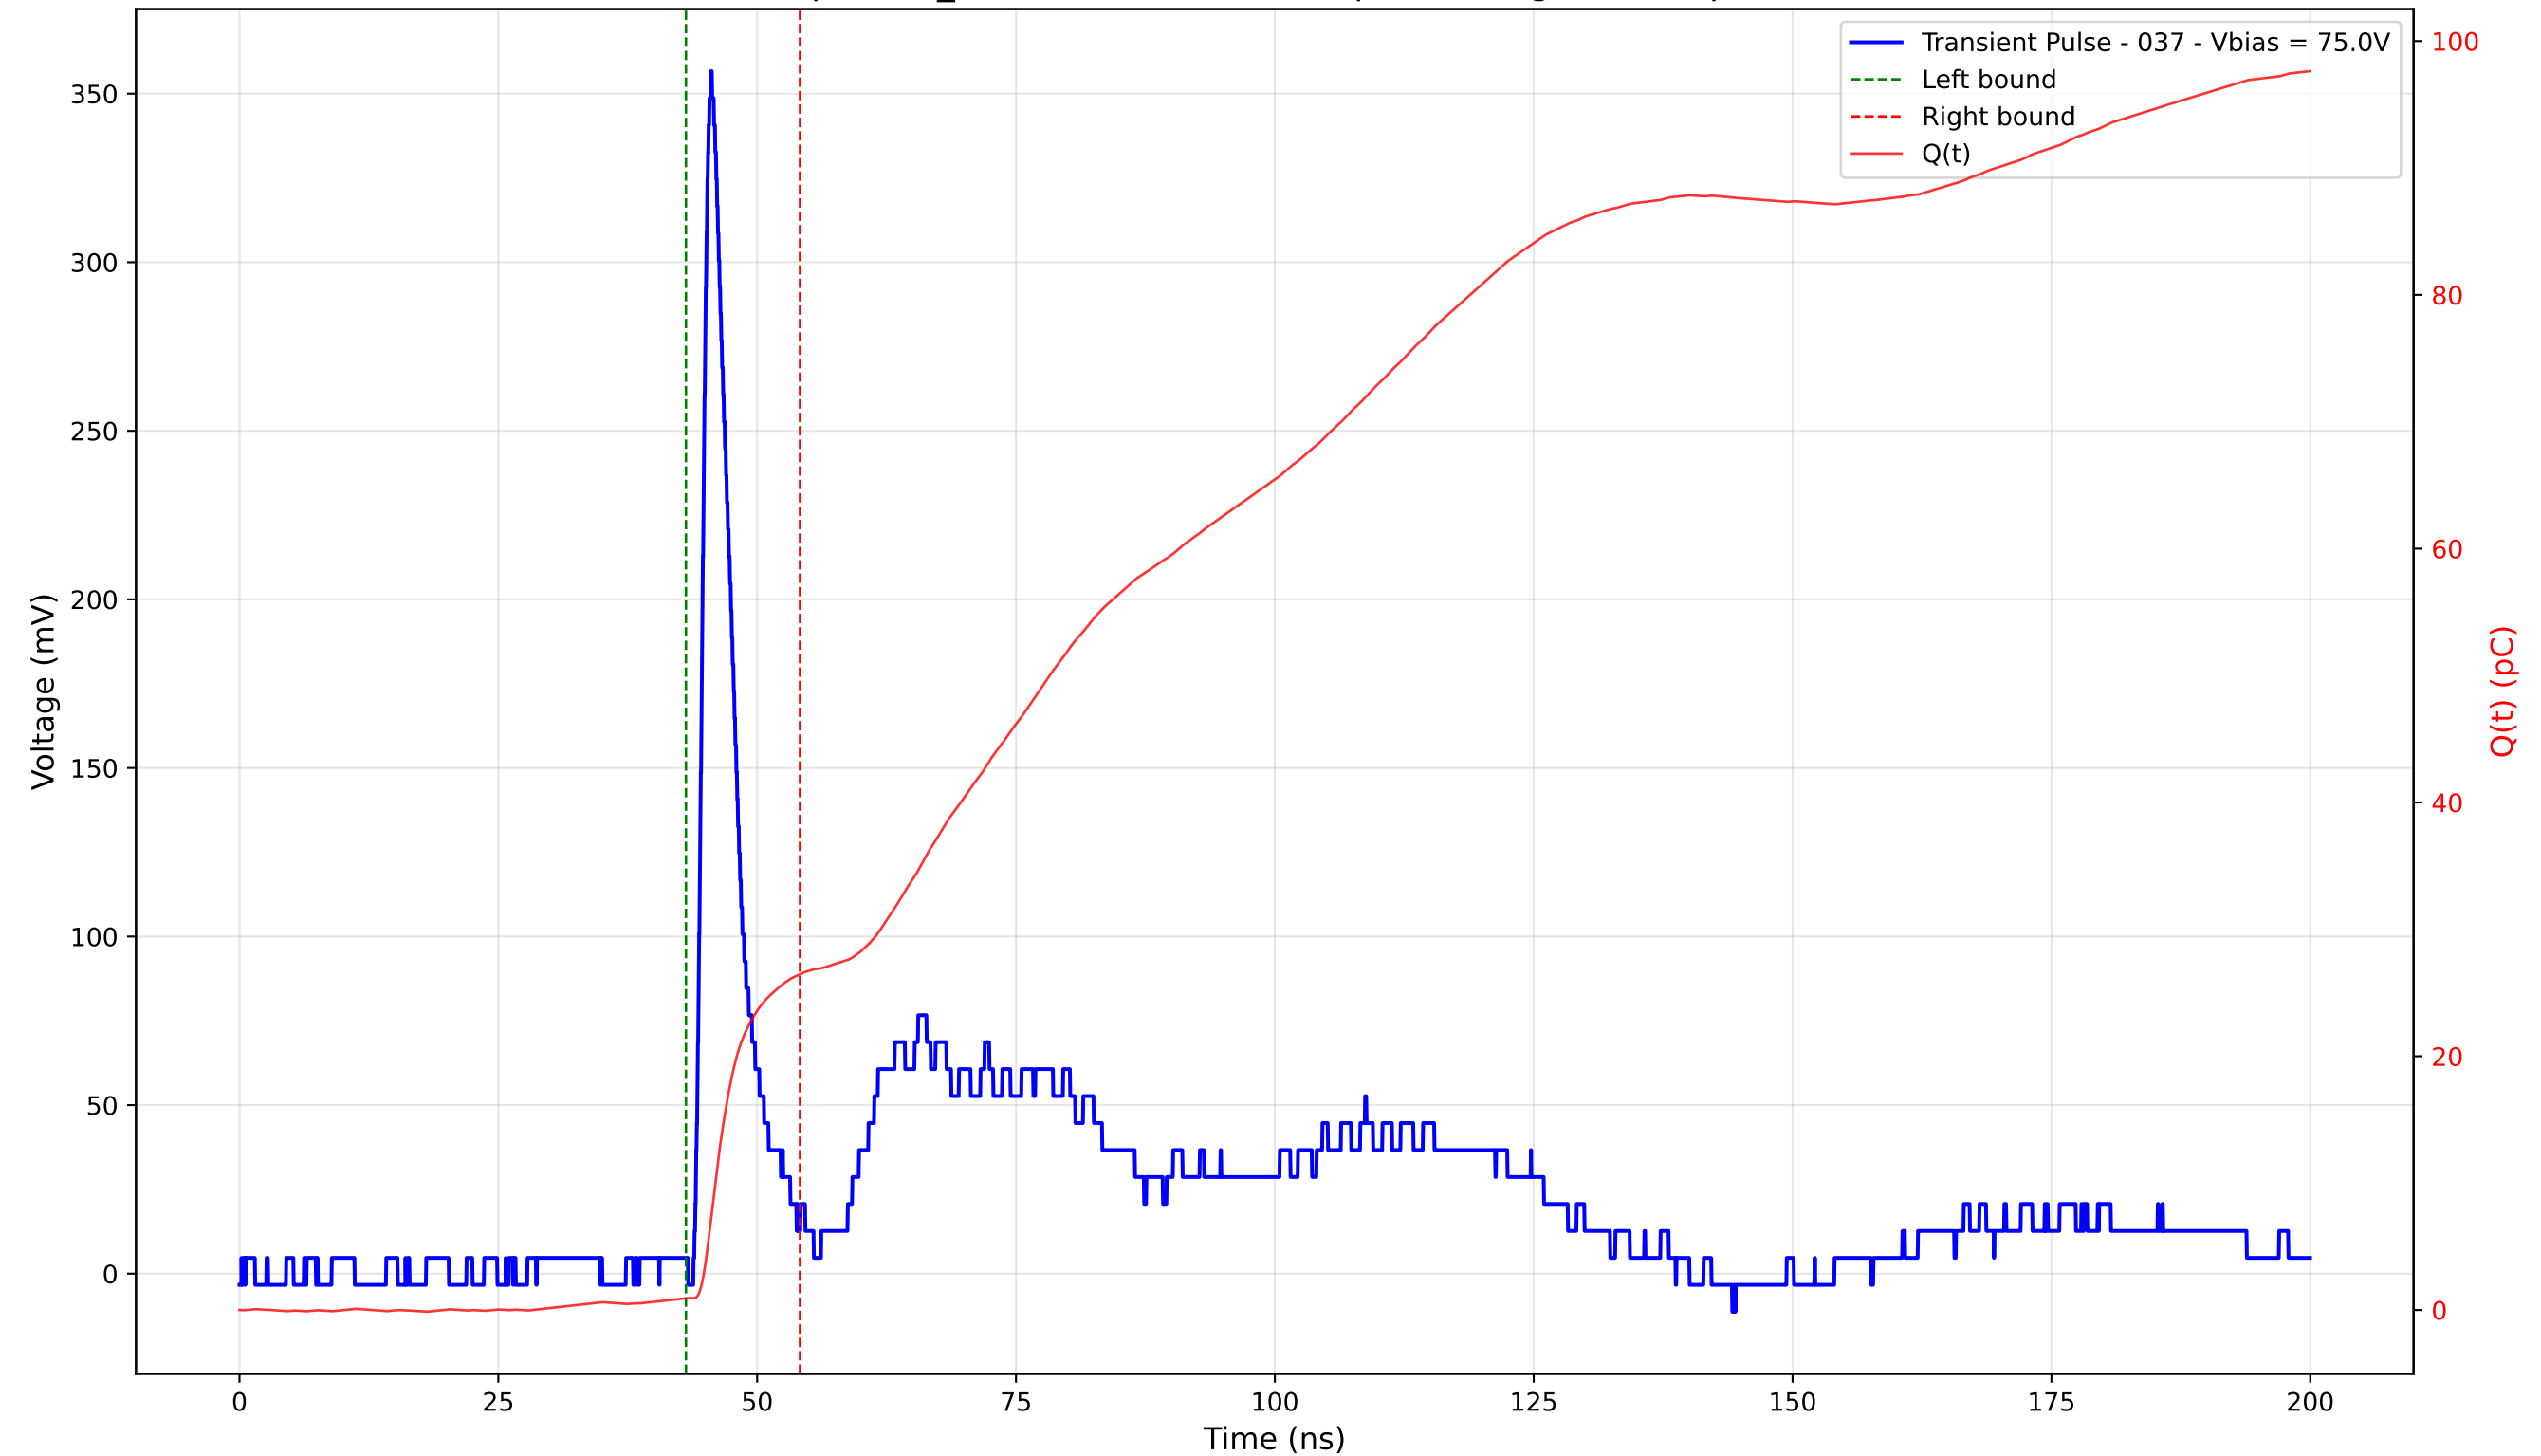


Transient Pulse - Sample: TD_4004 - Position: 265.0 μm - Charge: 23.09 pC - Rise Time: 1.04 ns

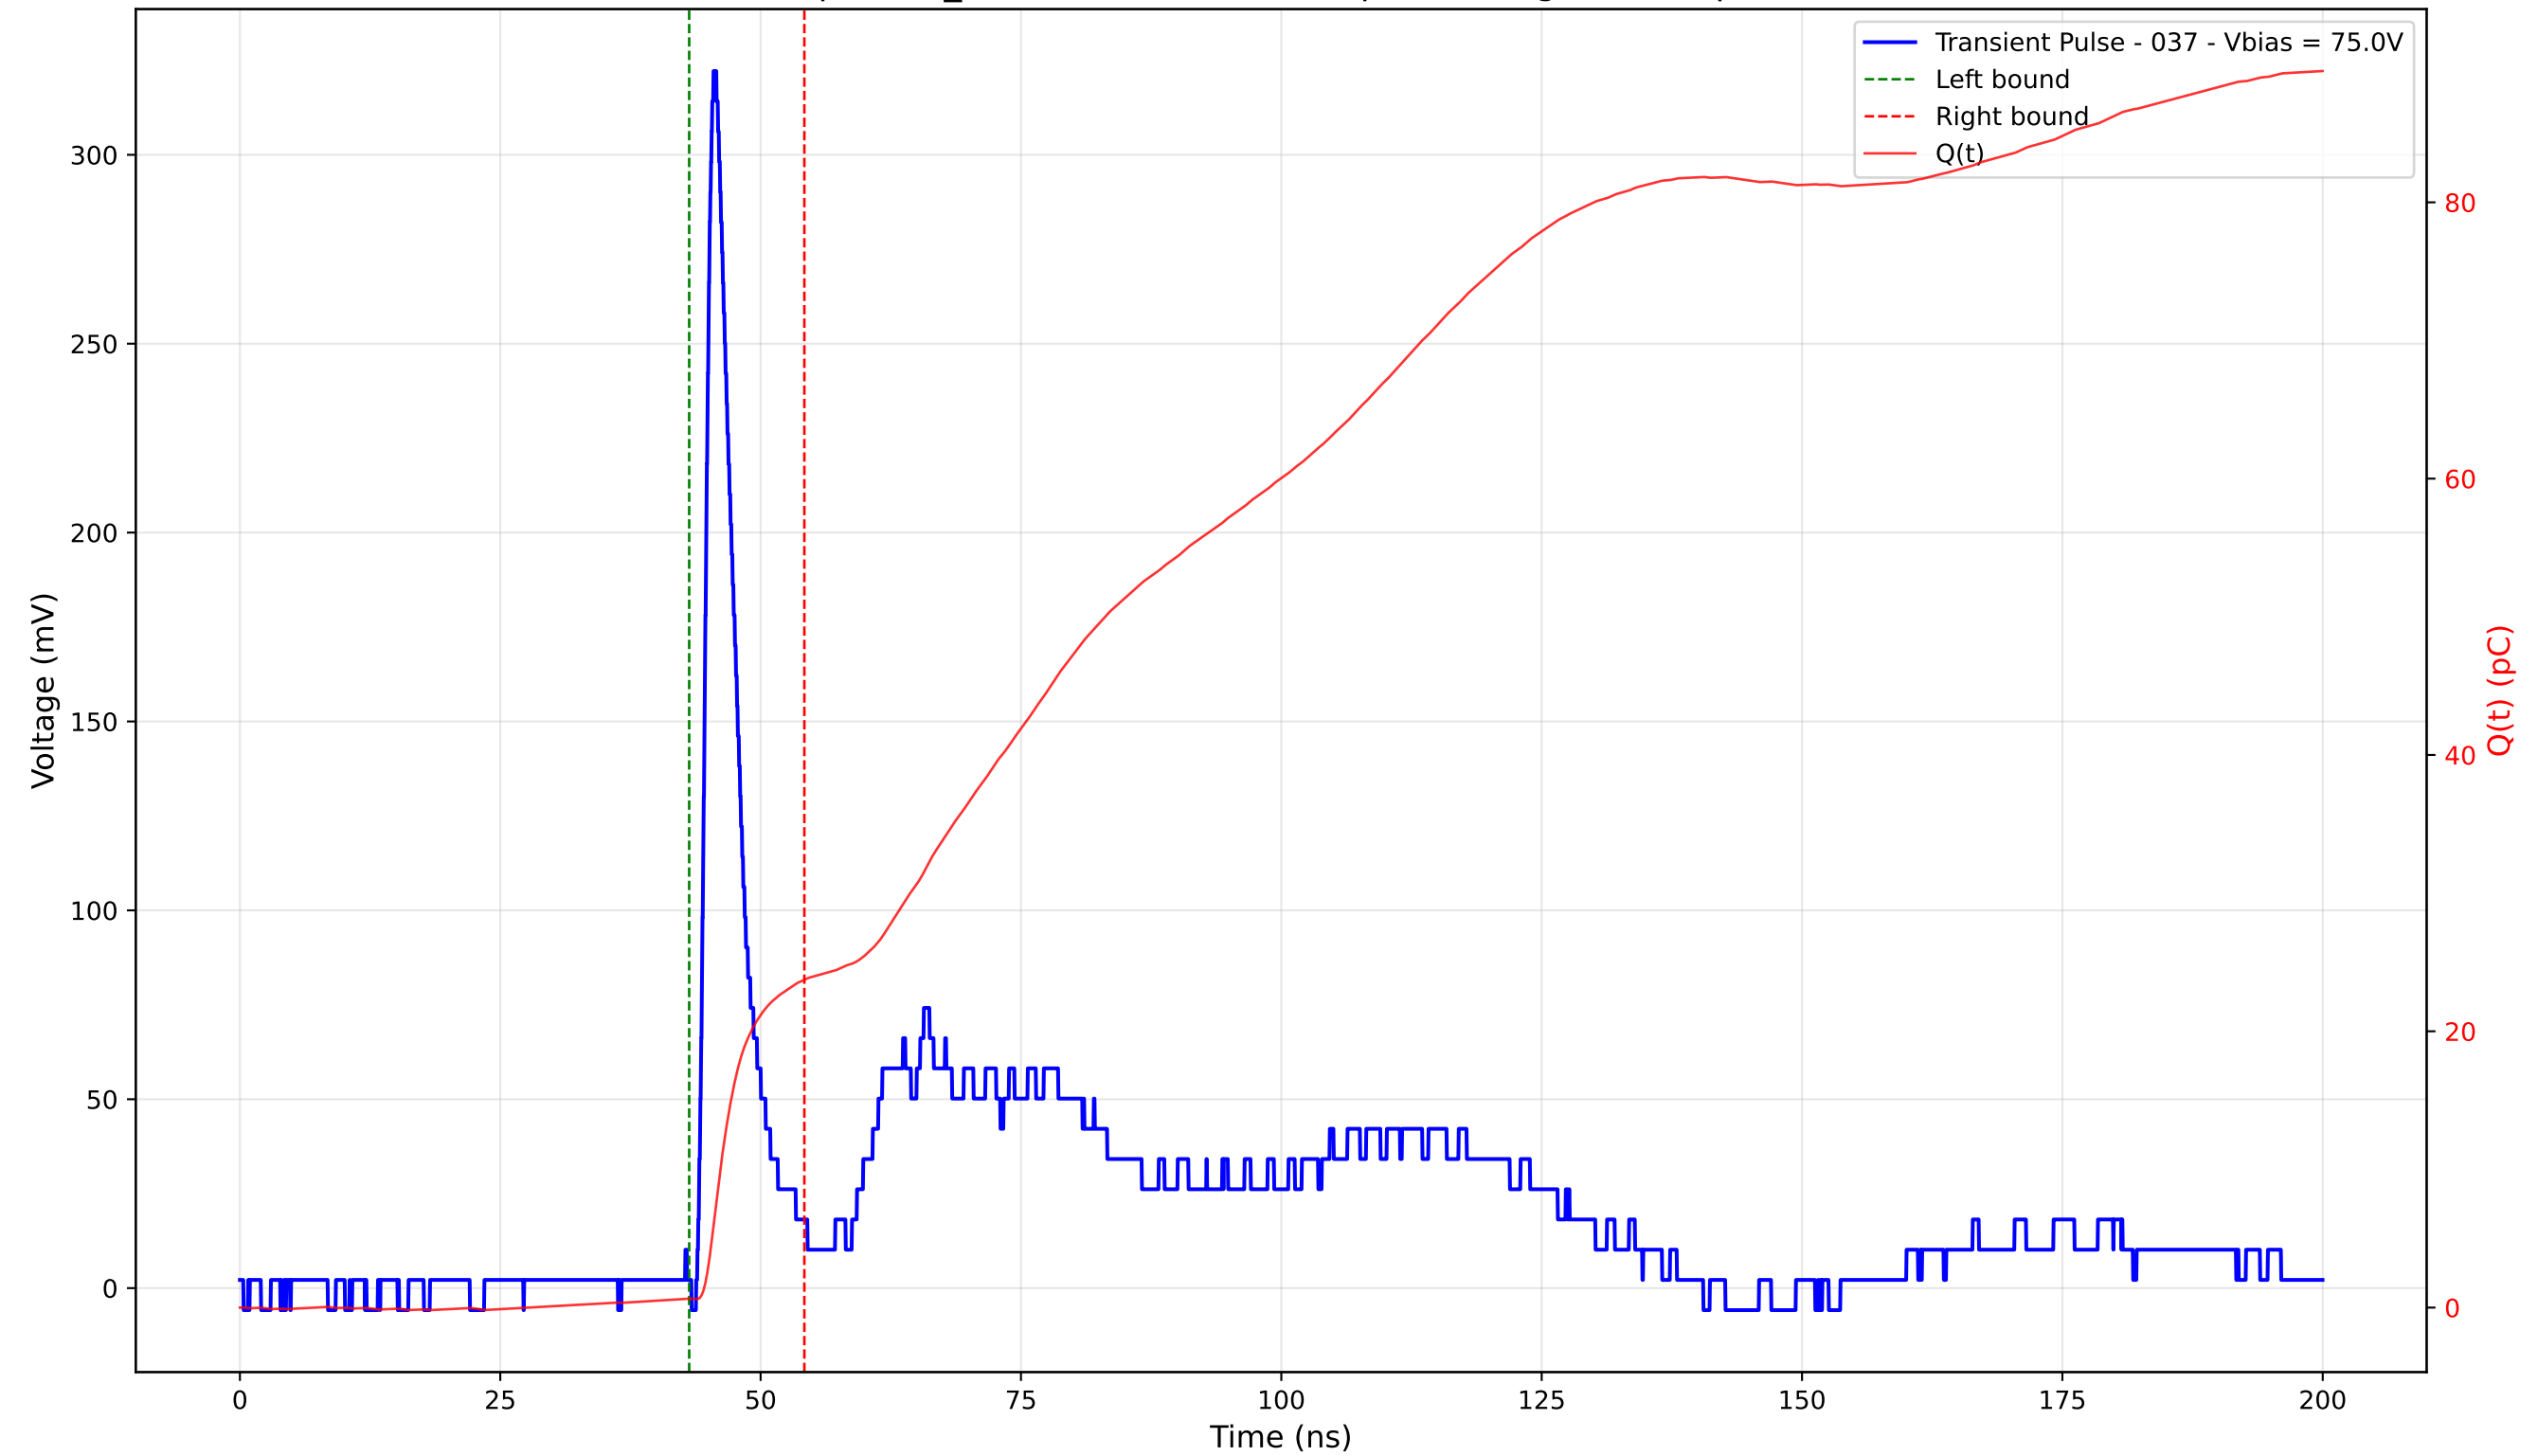


Transient Pulse - Sample: TD_4004 - Position: 270.0 μm - Charge: 22.46 pC - Rise Time: 1.04 ns

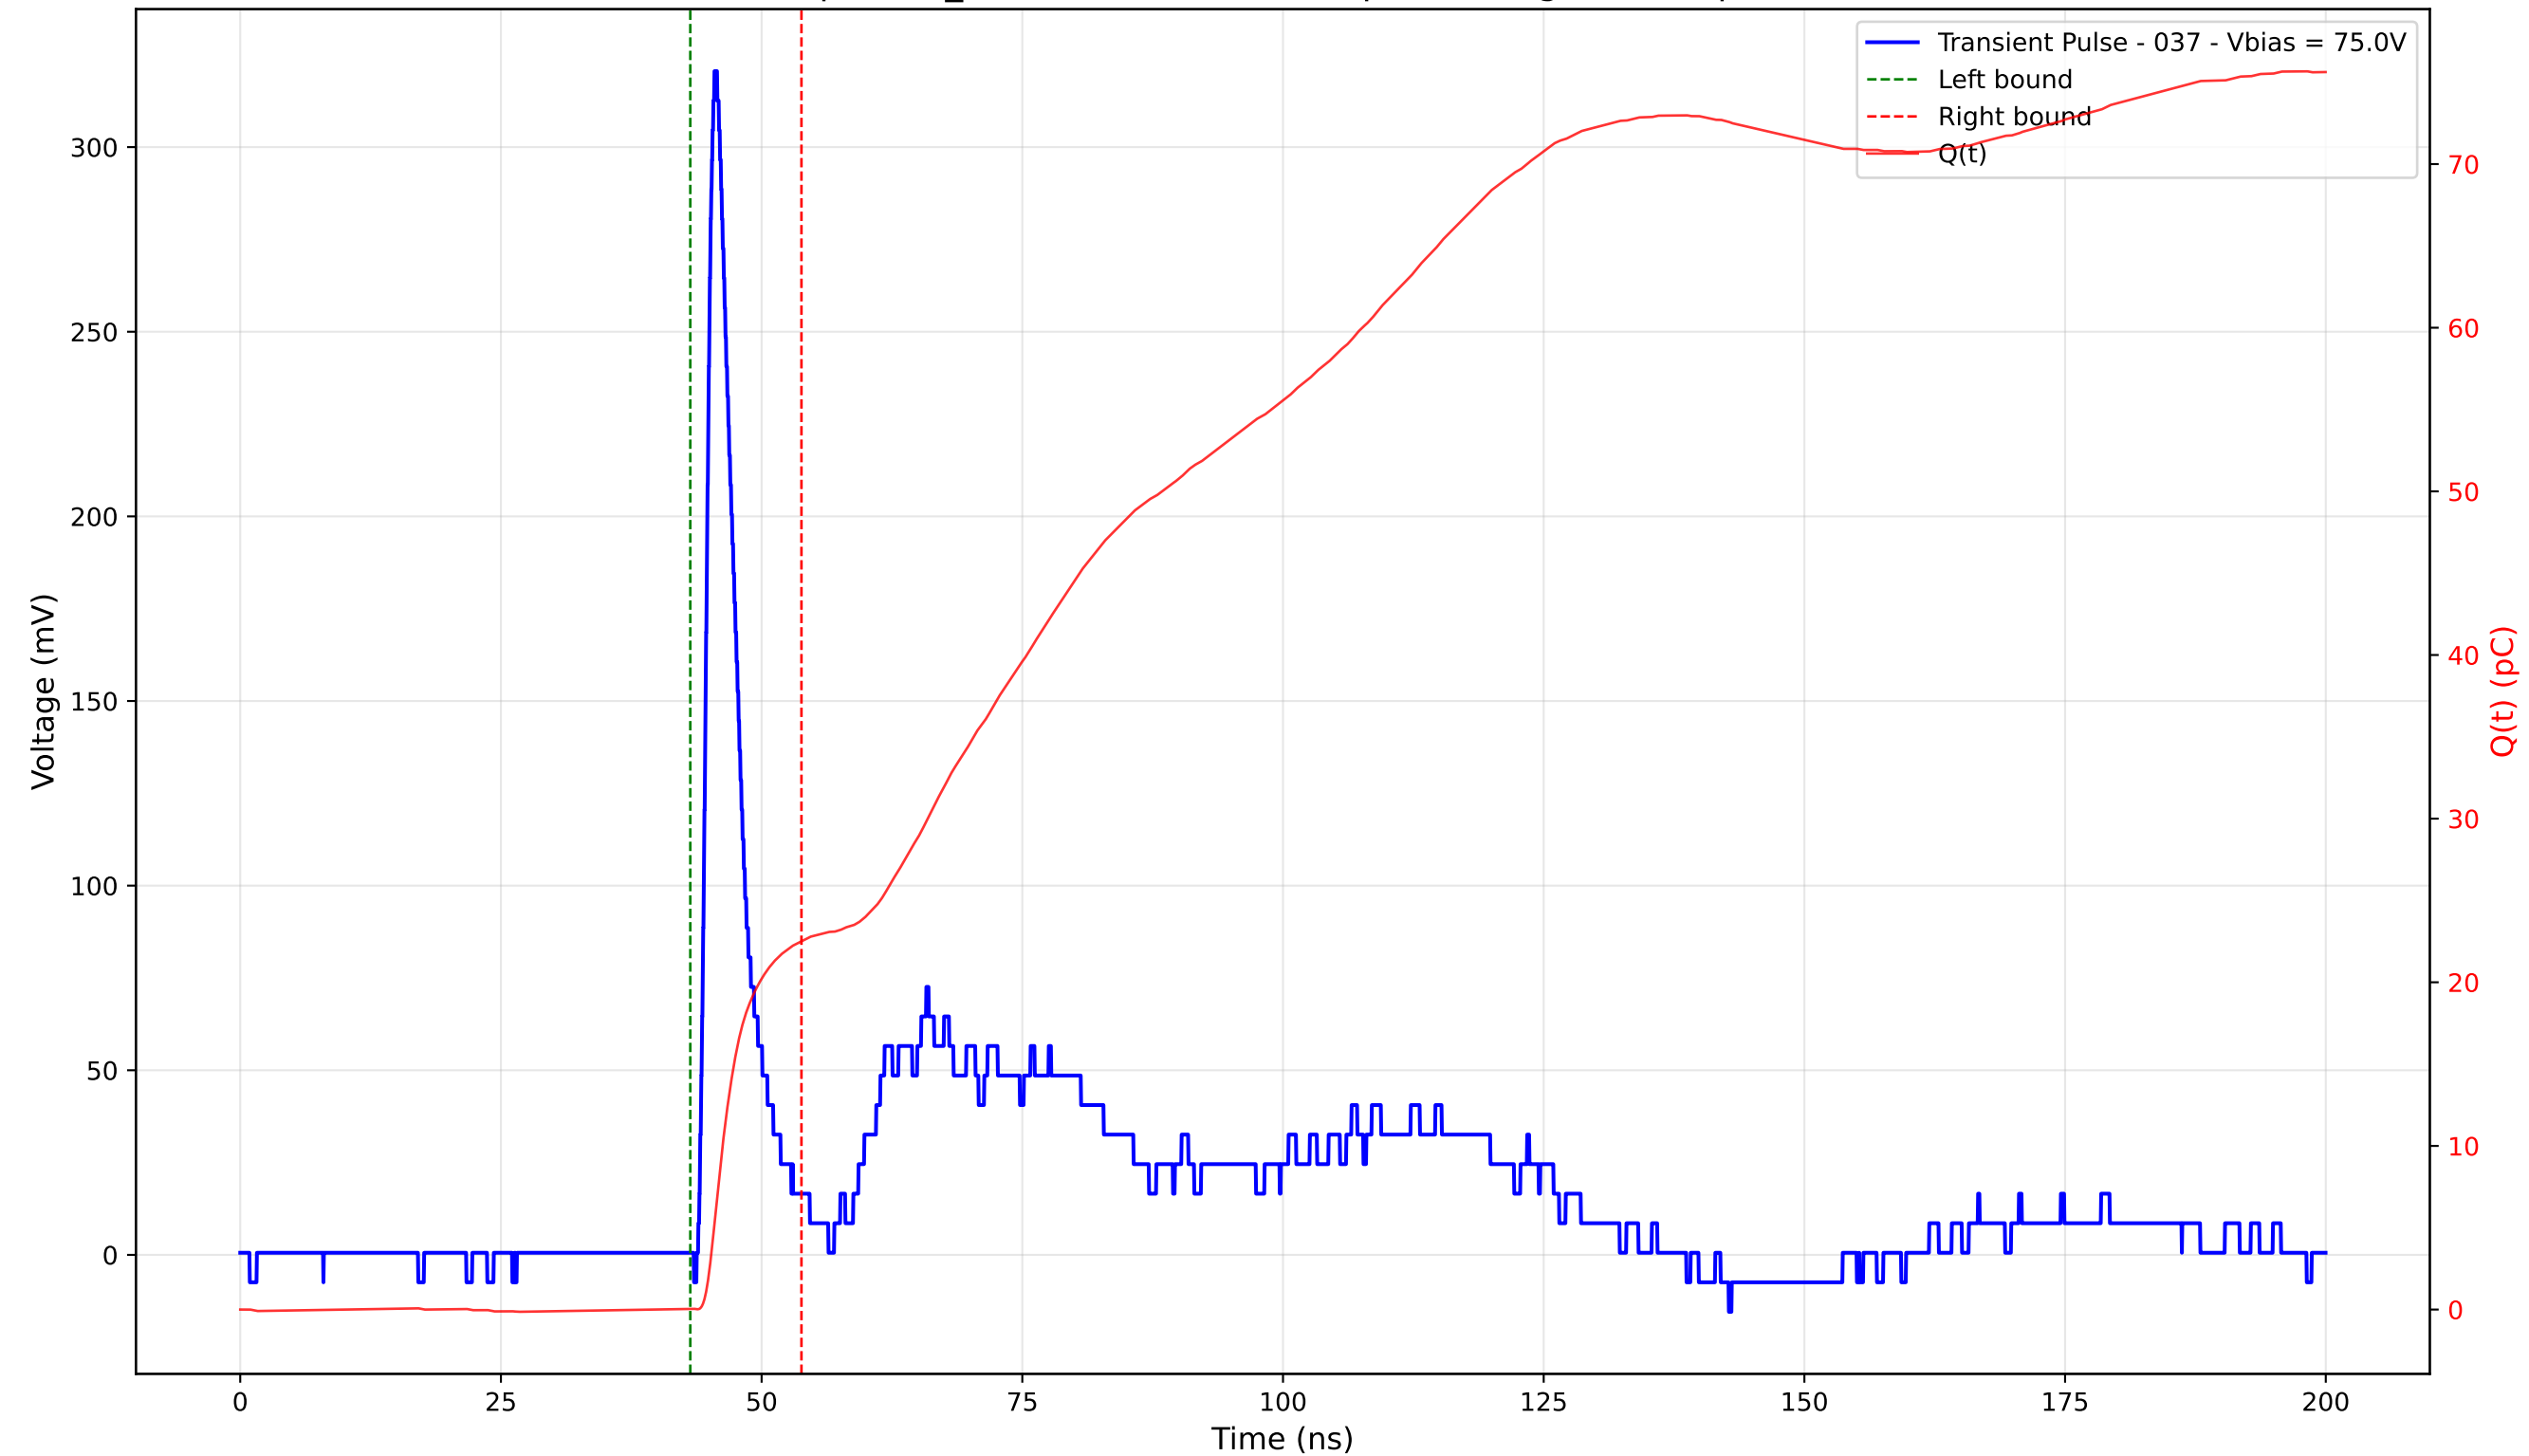


Transient Pulse - Sample: TD_4004 - Position: 275.0 μm - Charge: 25.24 pC - Rise Time: 1.07 ns

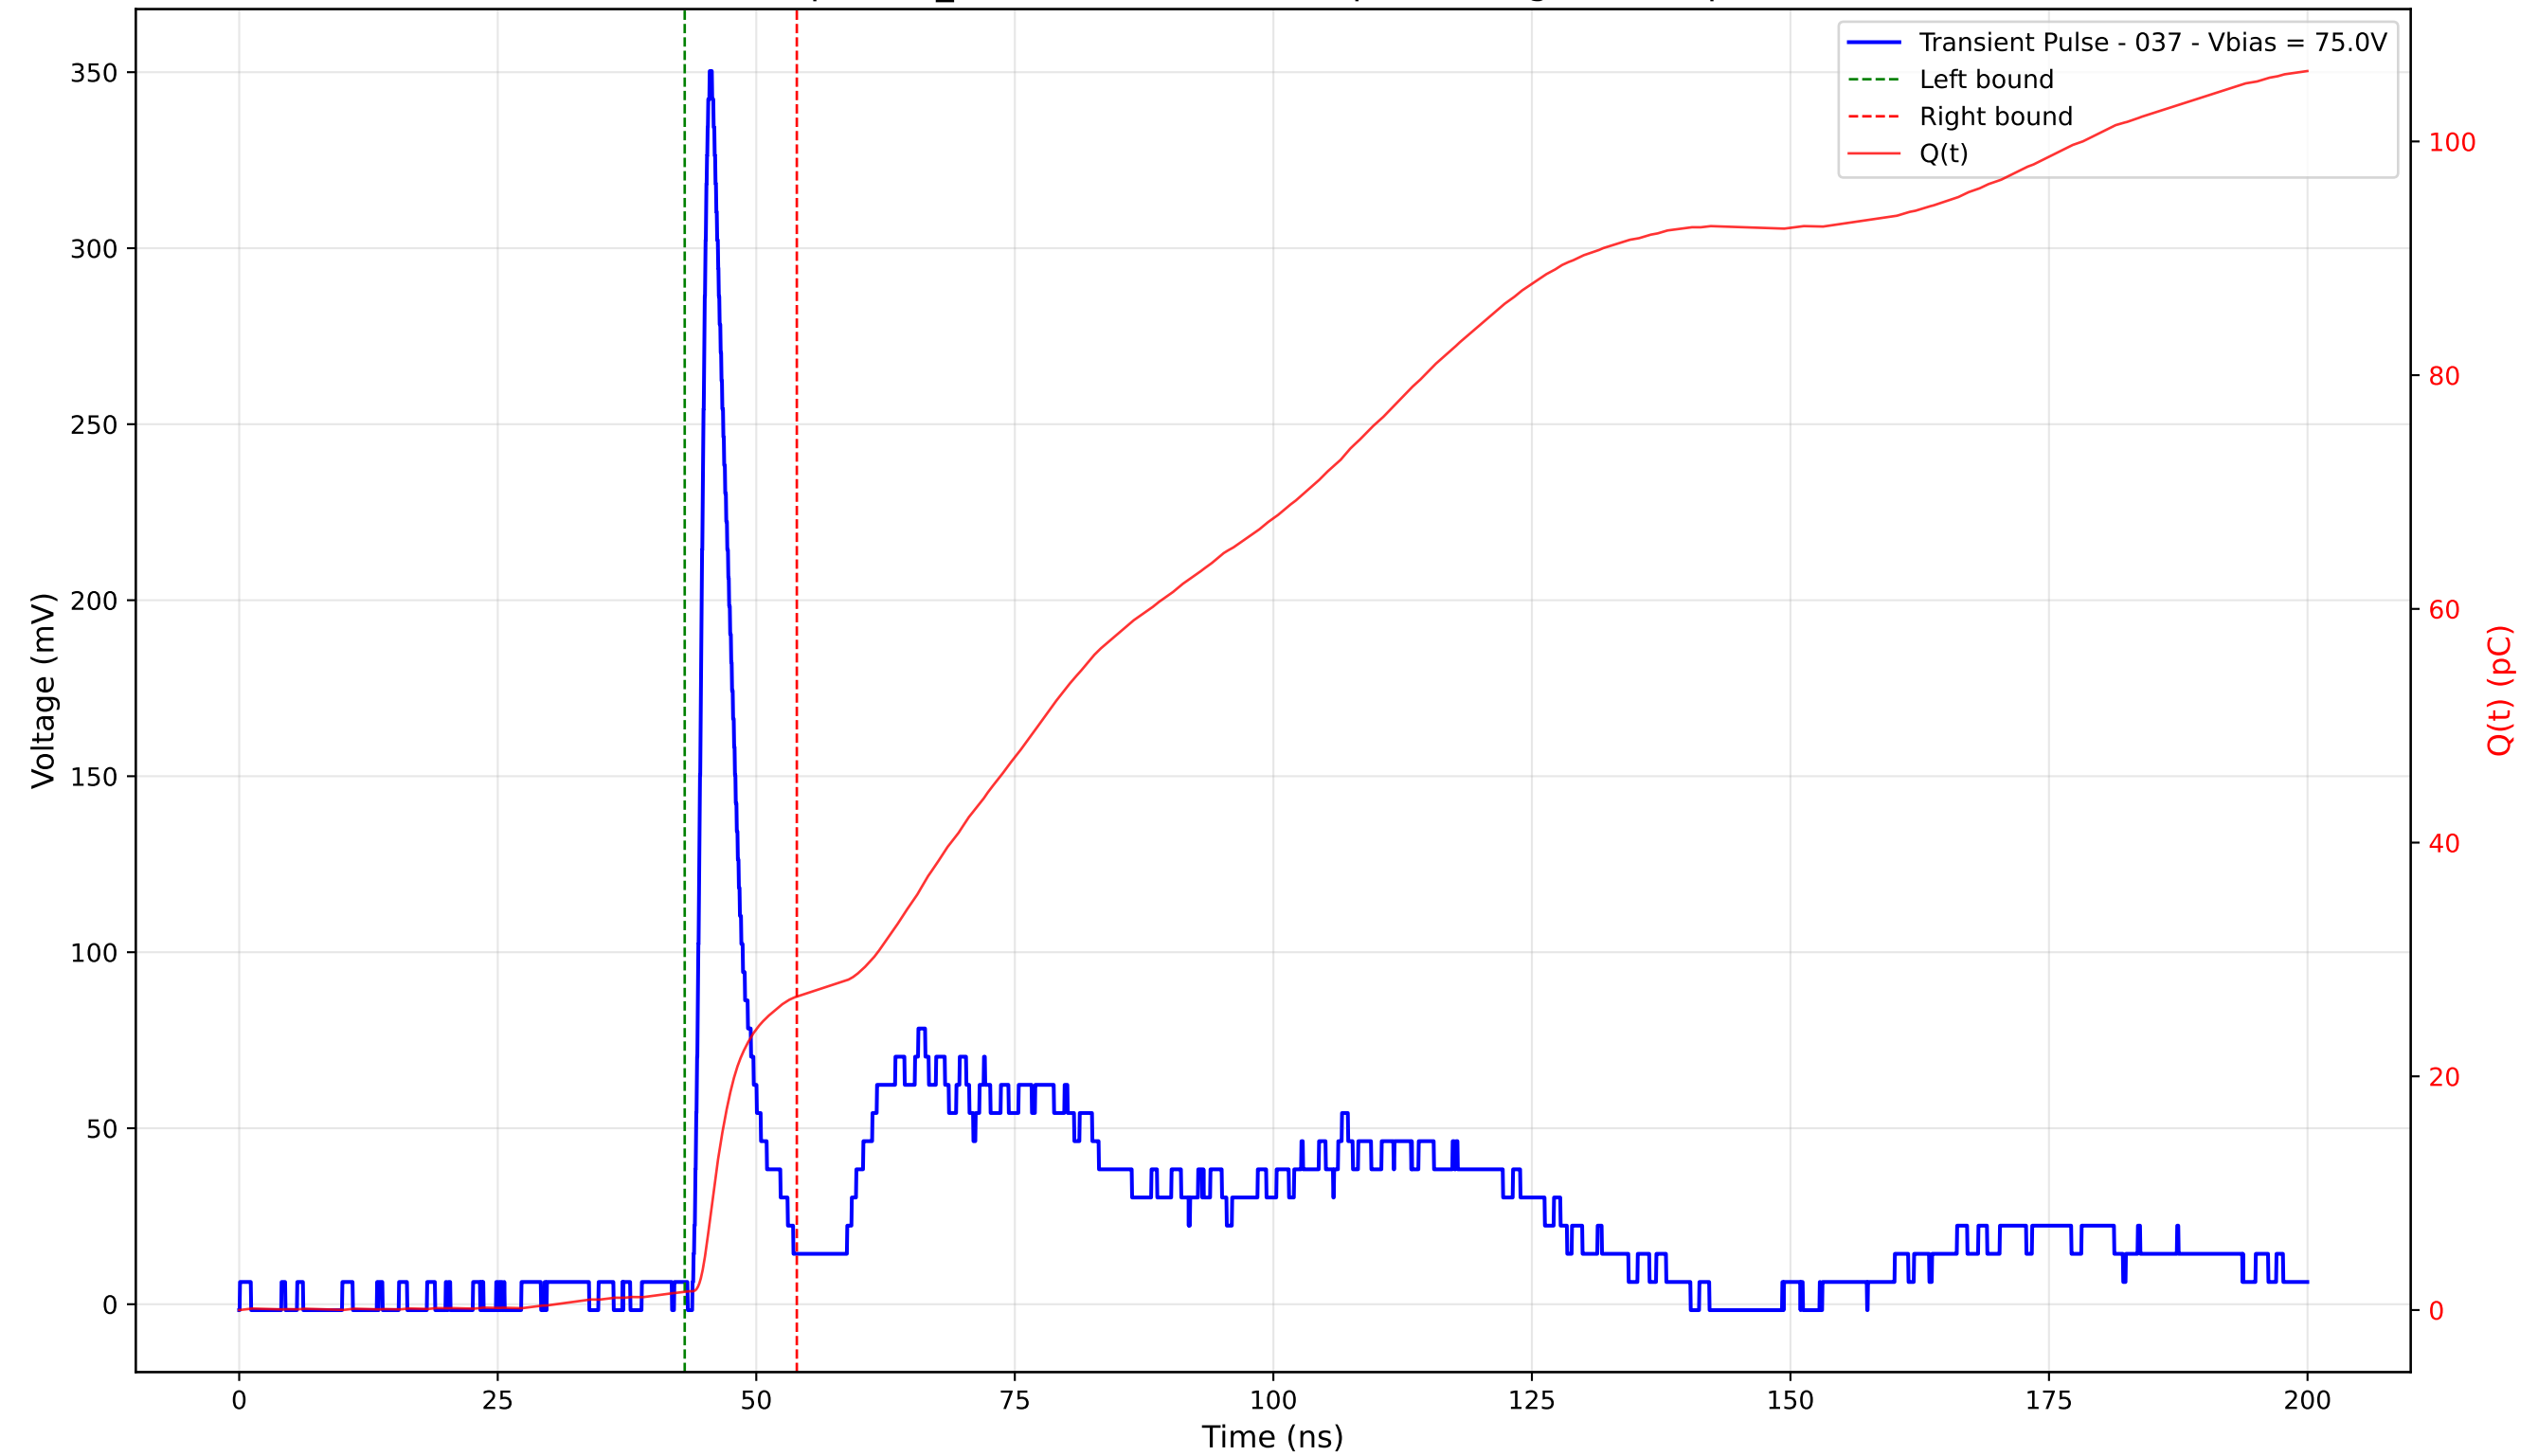


Transient Pulse - Sample: TD_4004 - Position: 280.0 μm - Charge: 25.71 pC - Rise Time: 1.04 ns

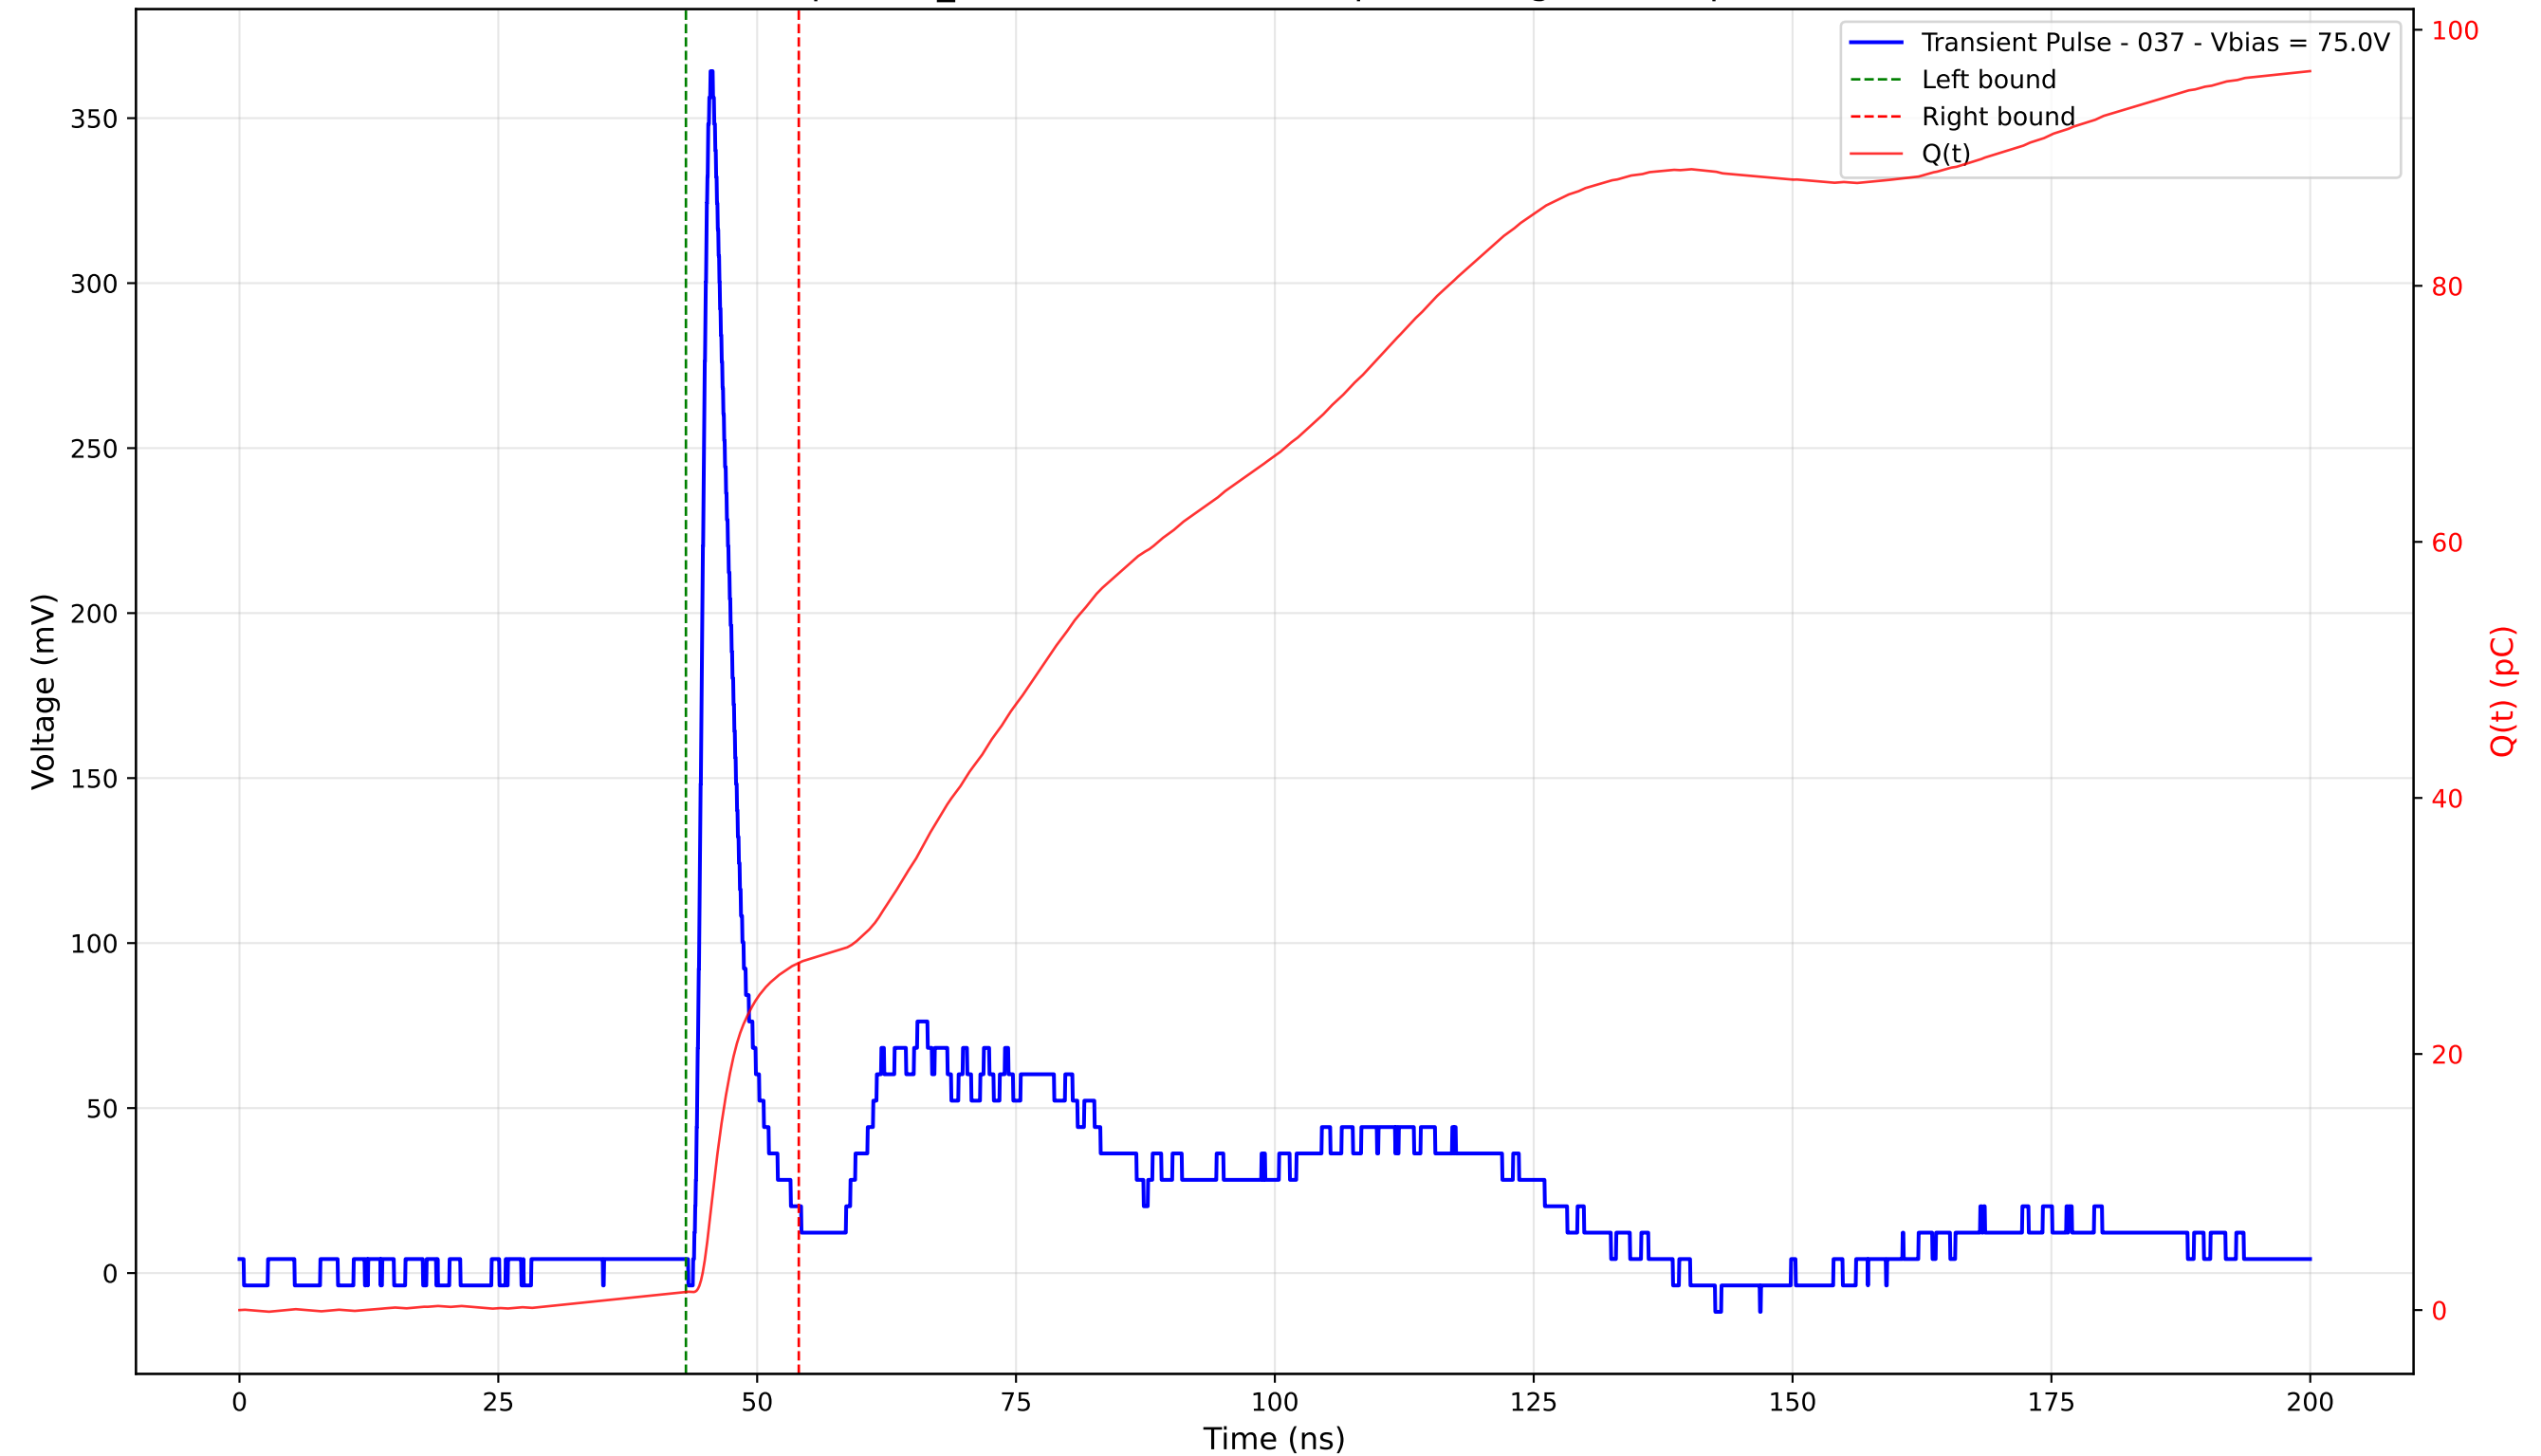


Transient Pulse - Sample: TD_4004 - Position: 285.0 μm - Charge: 23.54 pC - Rise Time: 1.06 ns

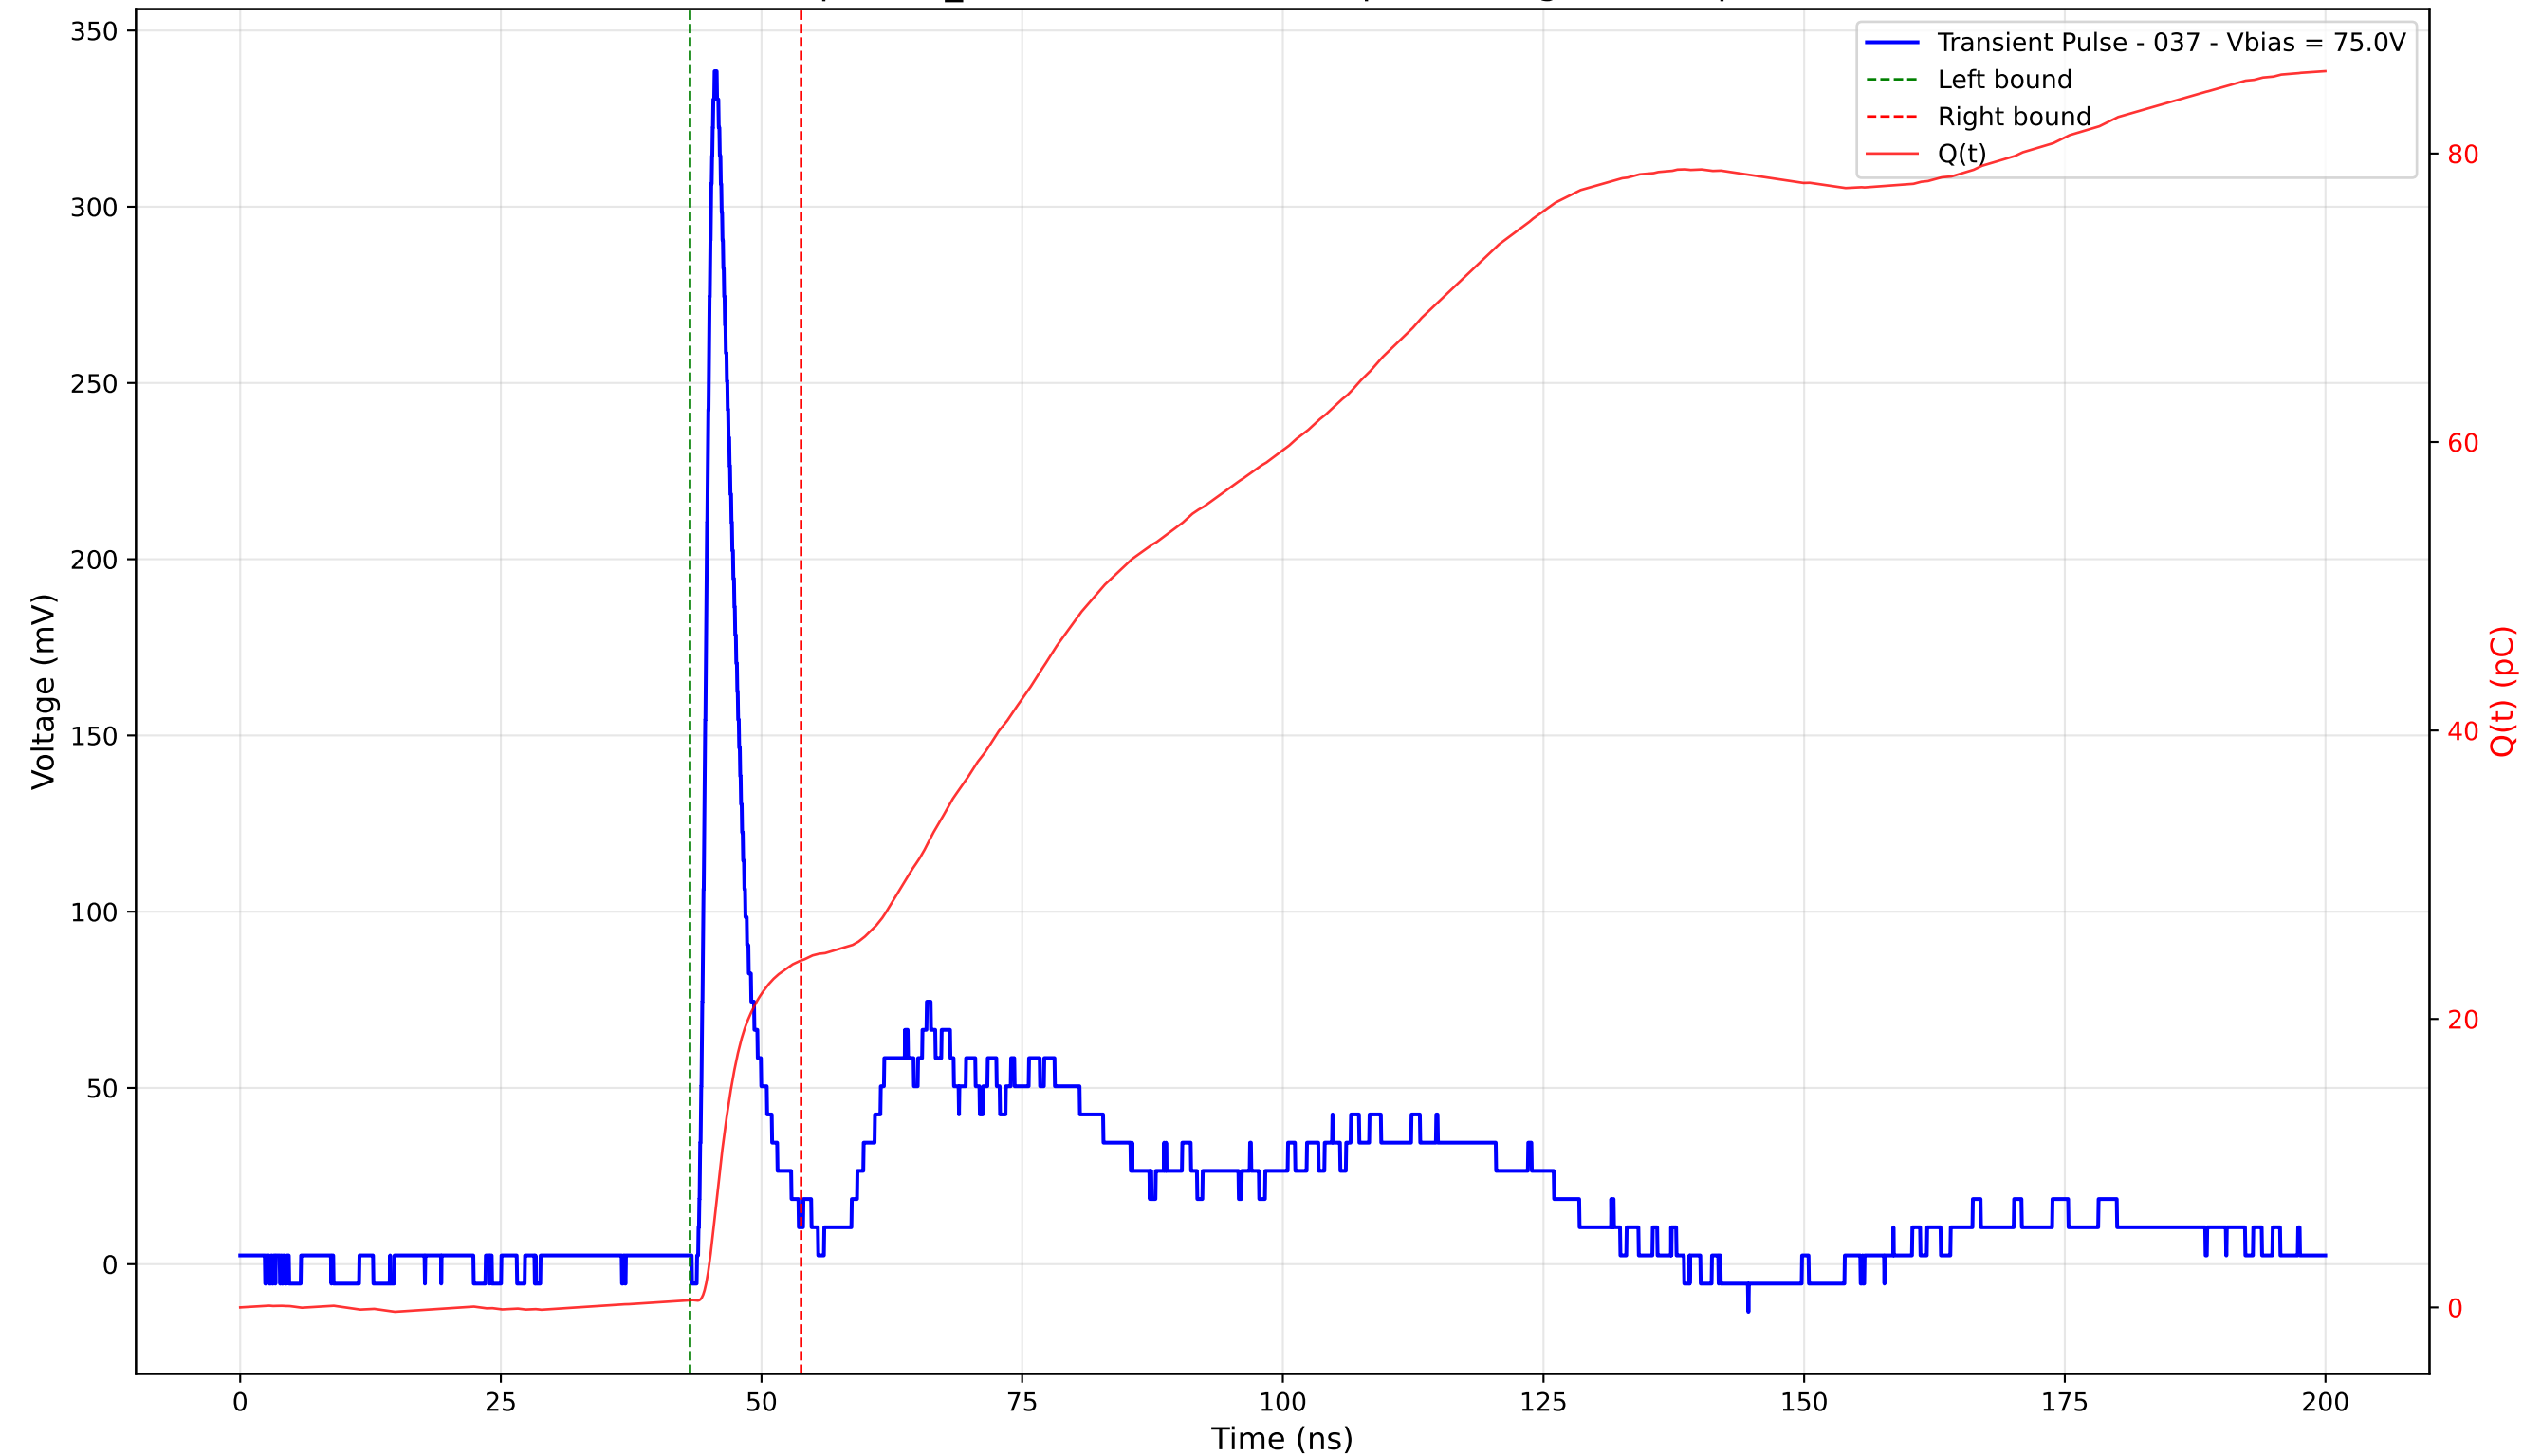


Transient Pulse - Sample: TD_4004 - Position: 290.0 μm - Charge: 21.24 pC - Rise Time: 1.07 ns

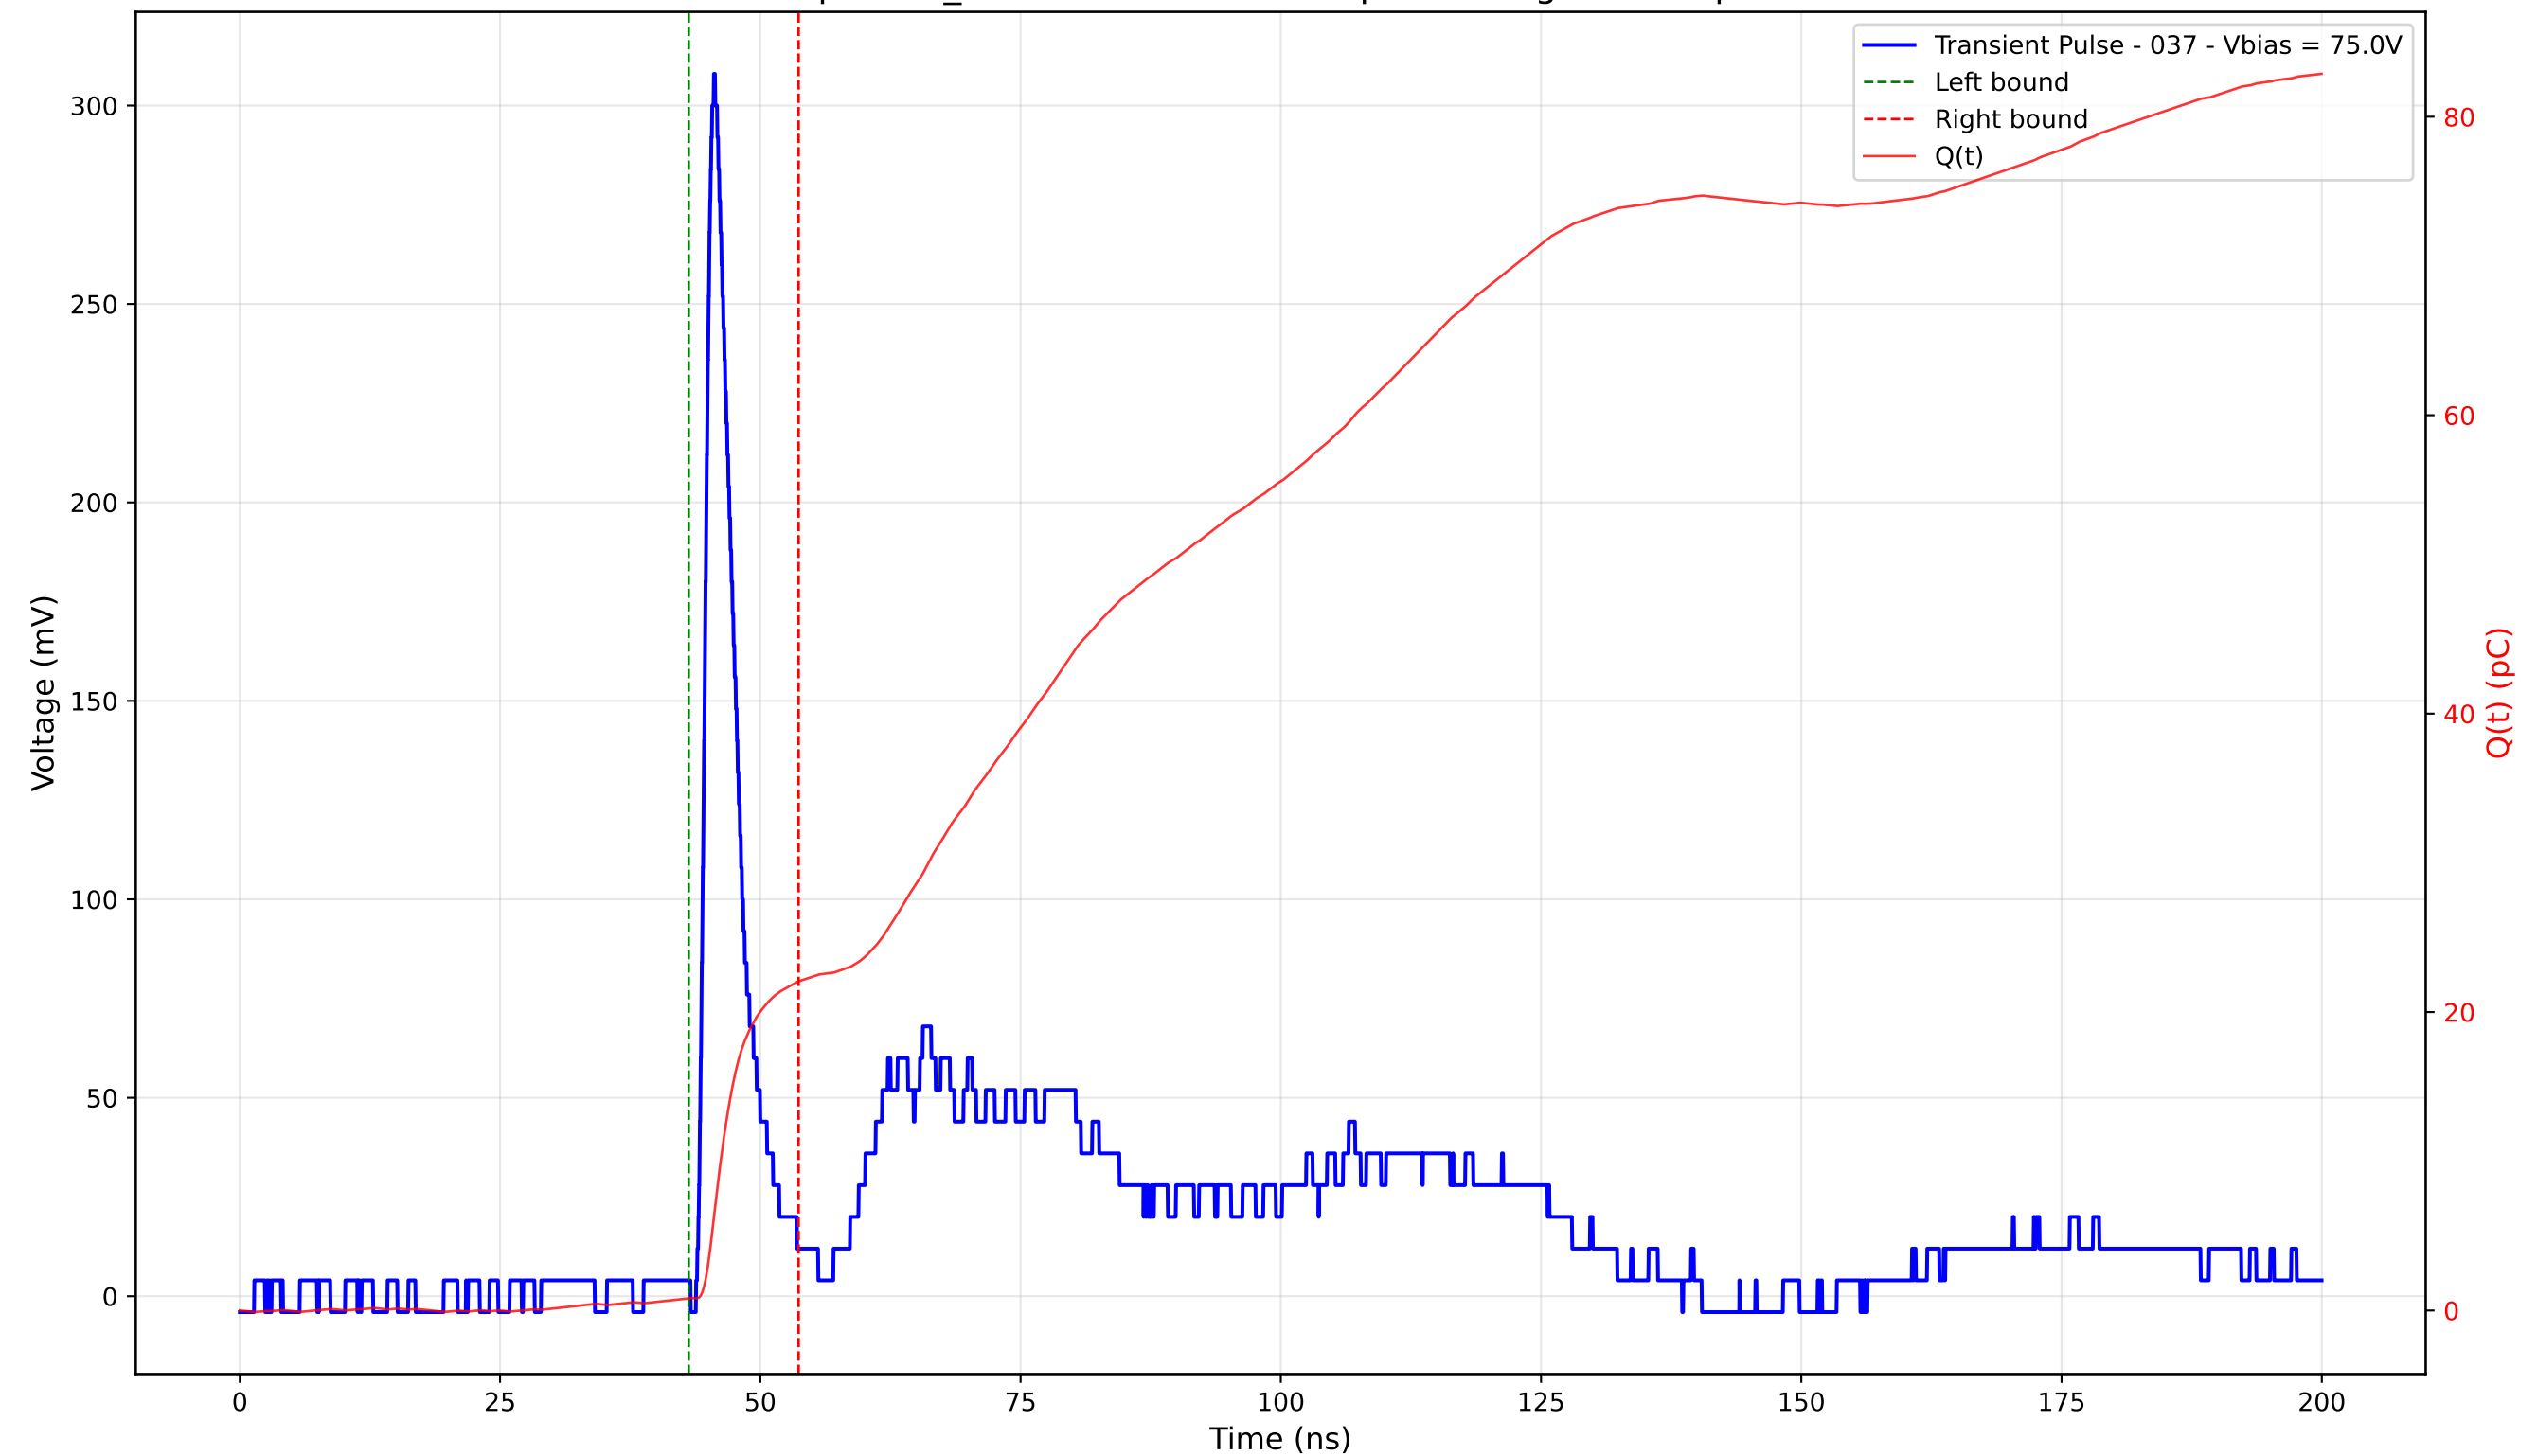


Transient Pulse - Sample: TD_4004 - Position: 295.0 μm - Charge: 19.30 pC - Rise Time: 1.06 ns

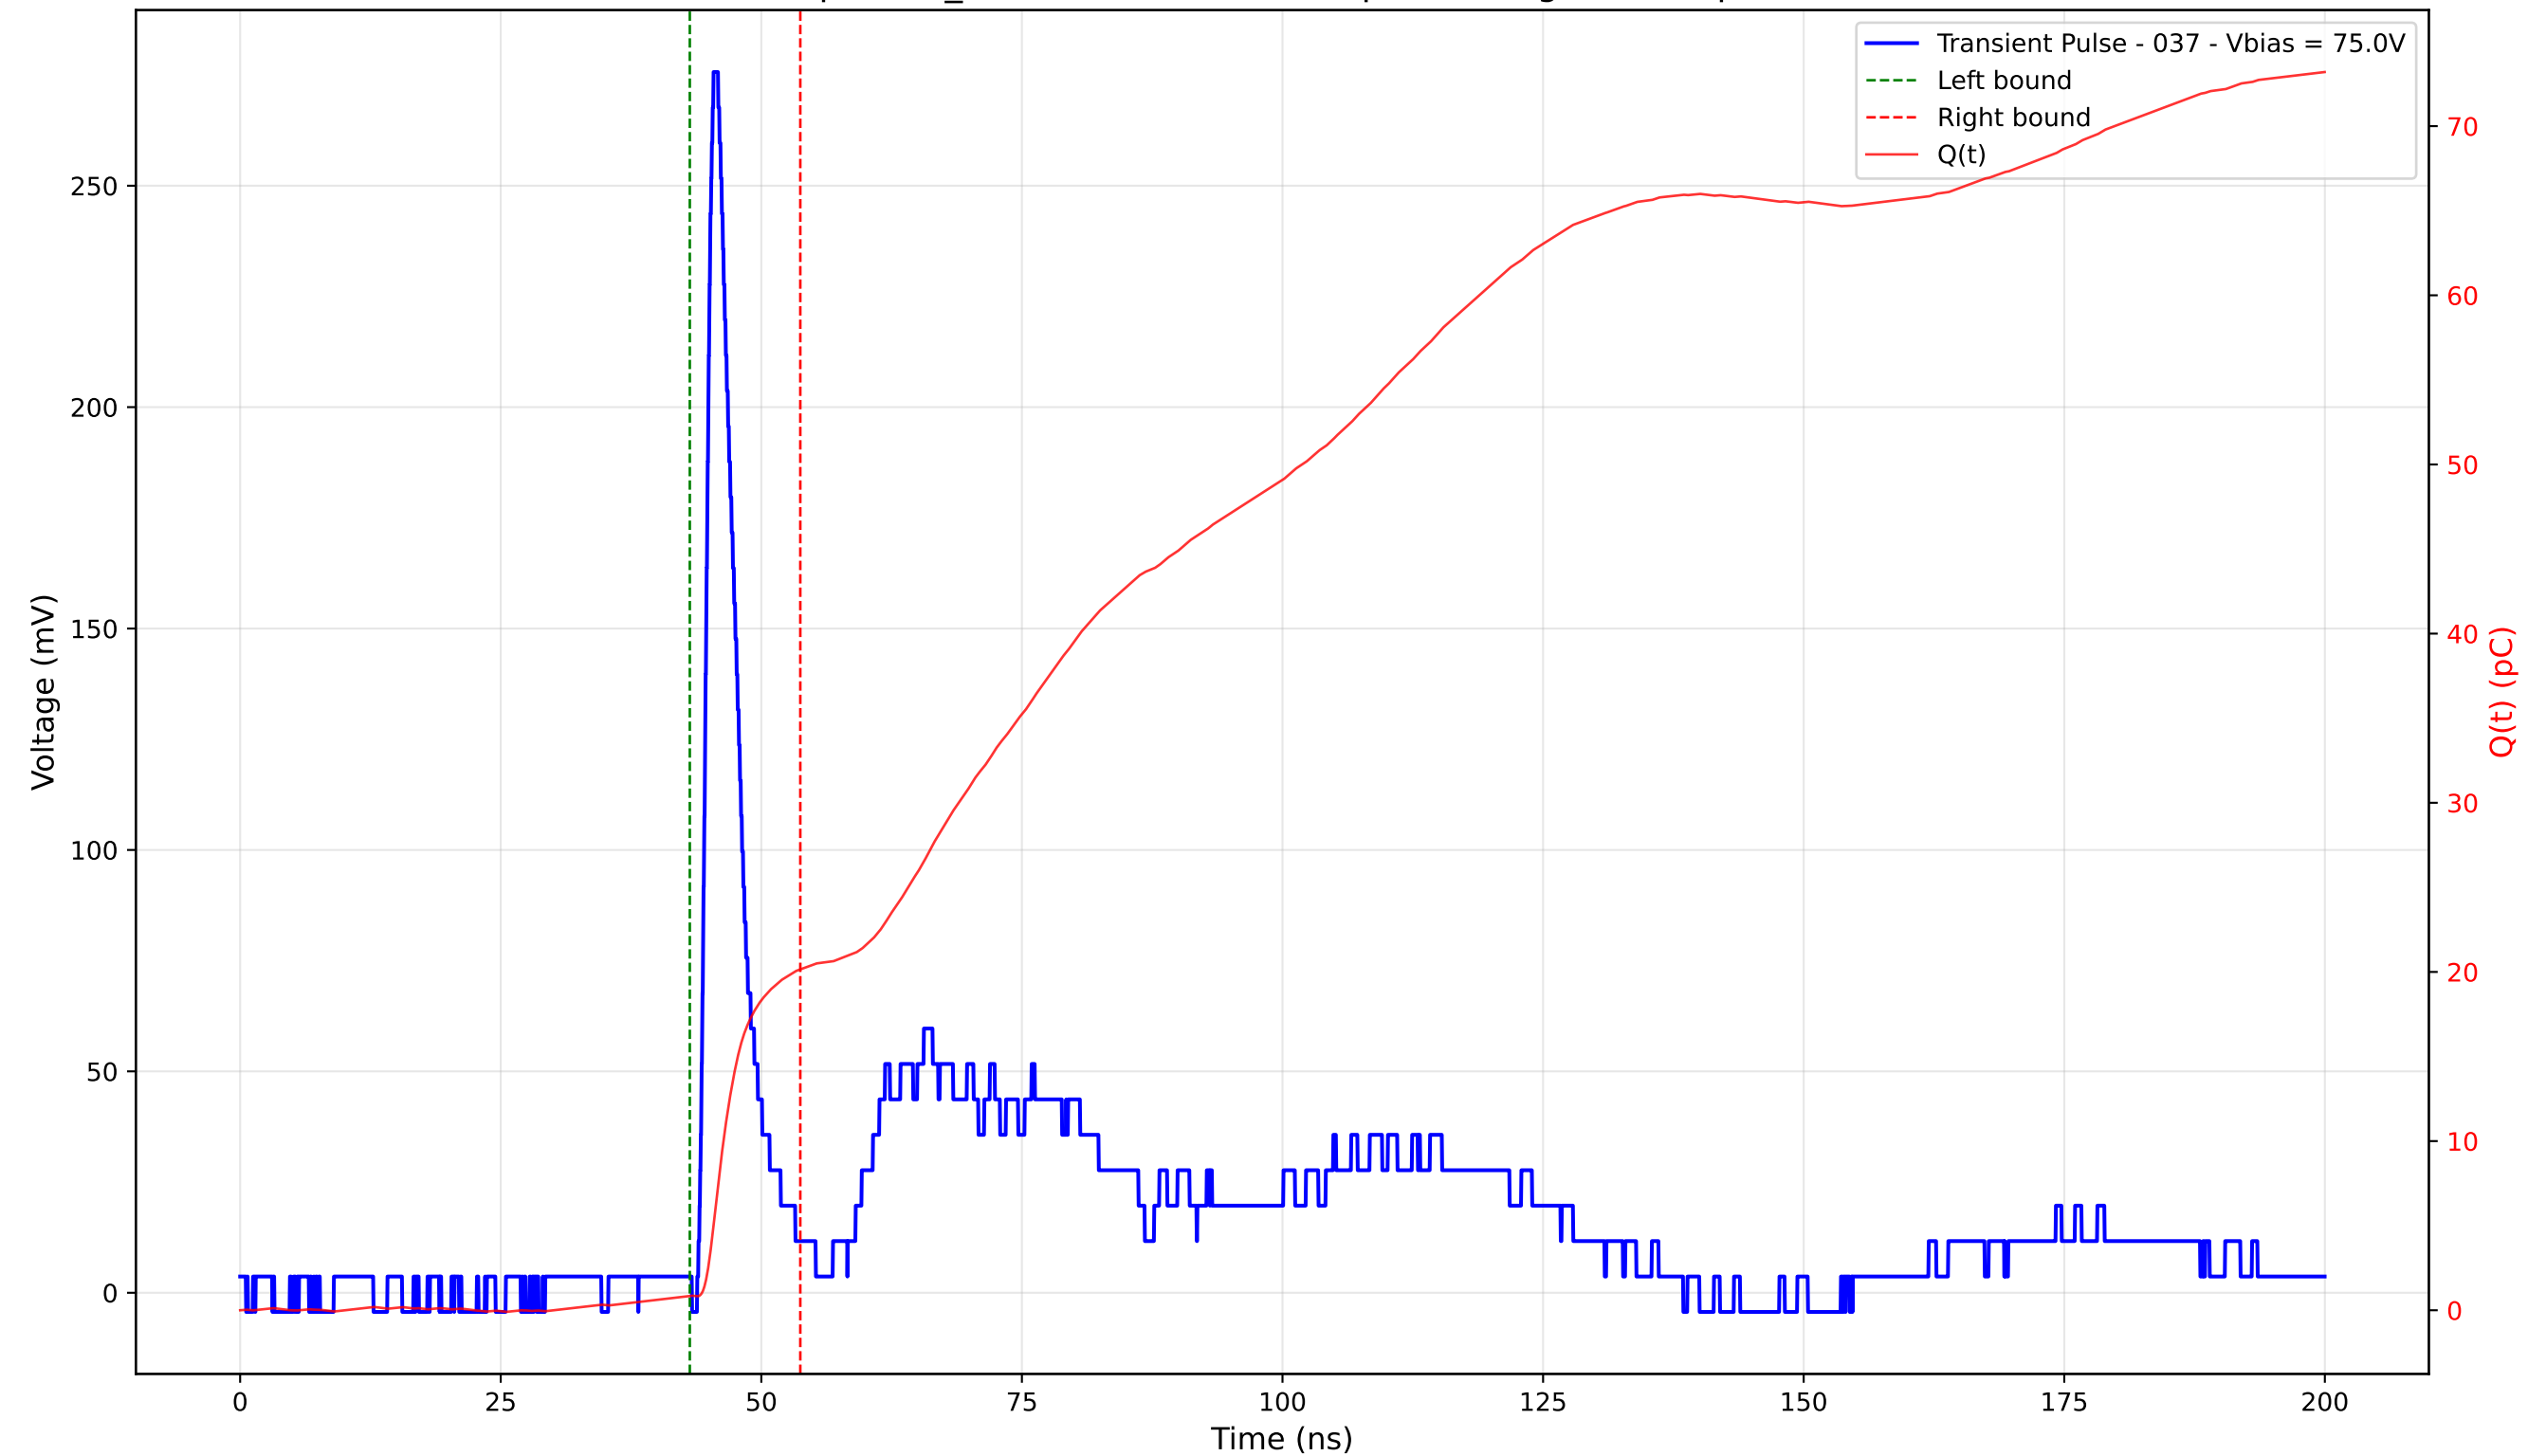


Transient Pulse - Sample: TD_4004 - Position: 300.0 μm - Charge: 19.47 pC - Rise Time: 1.05 ns

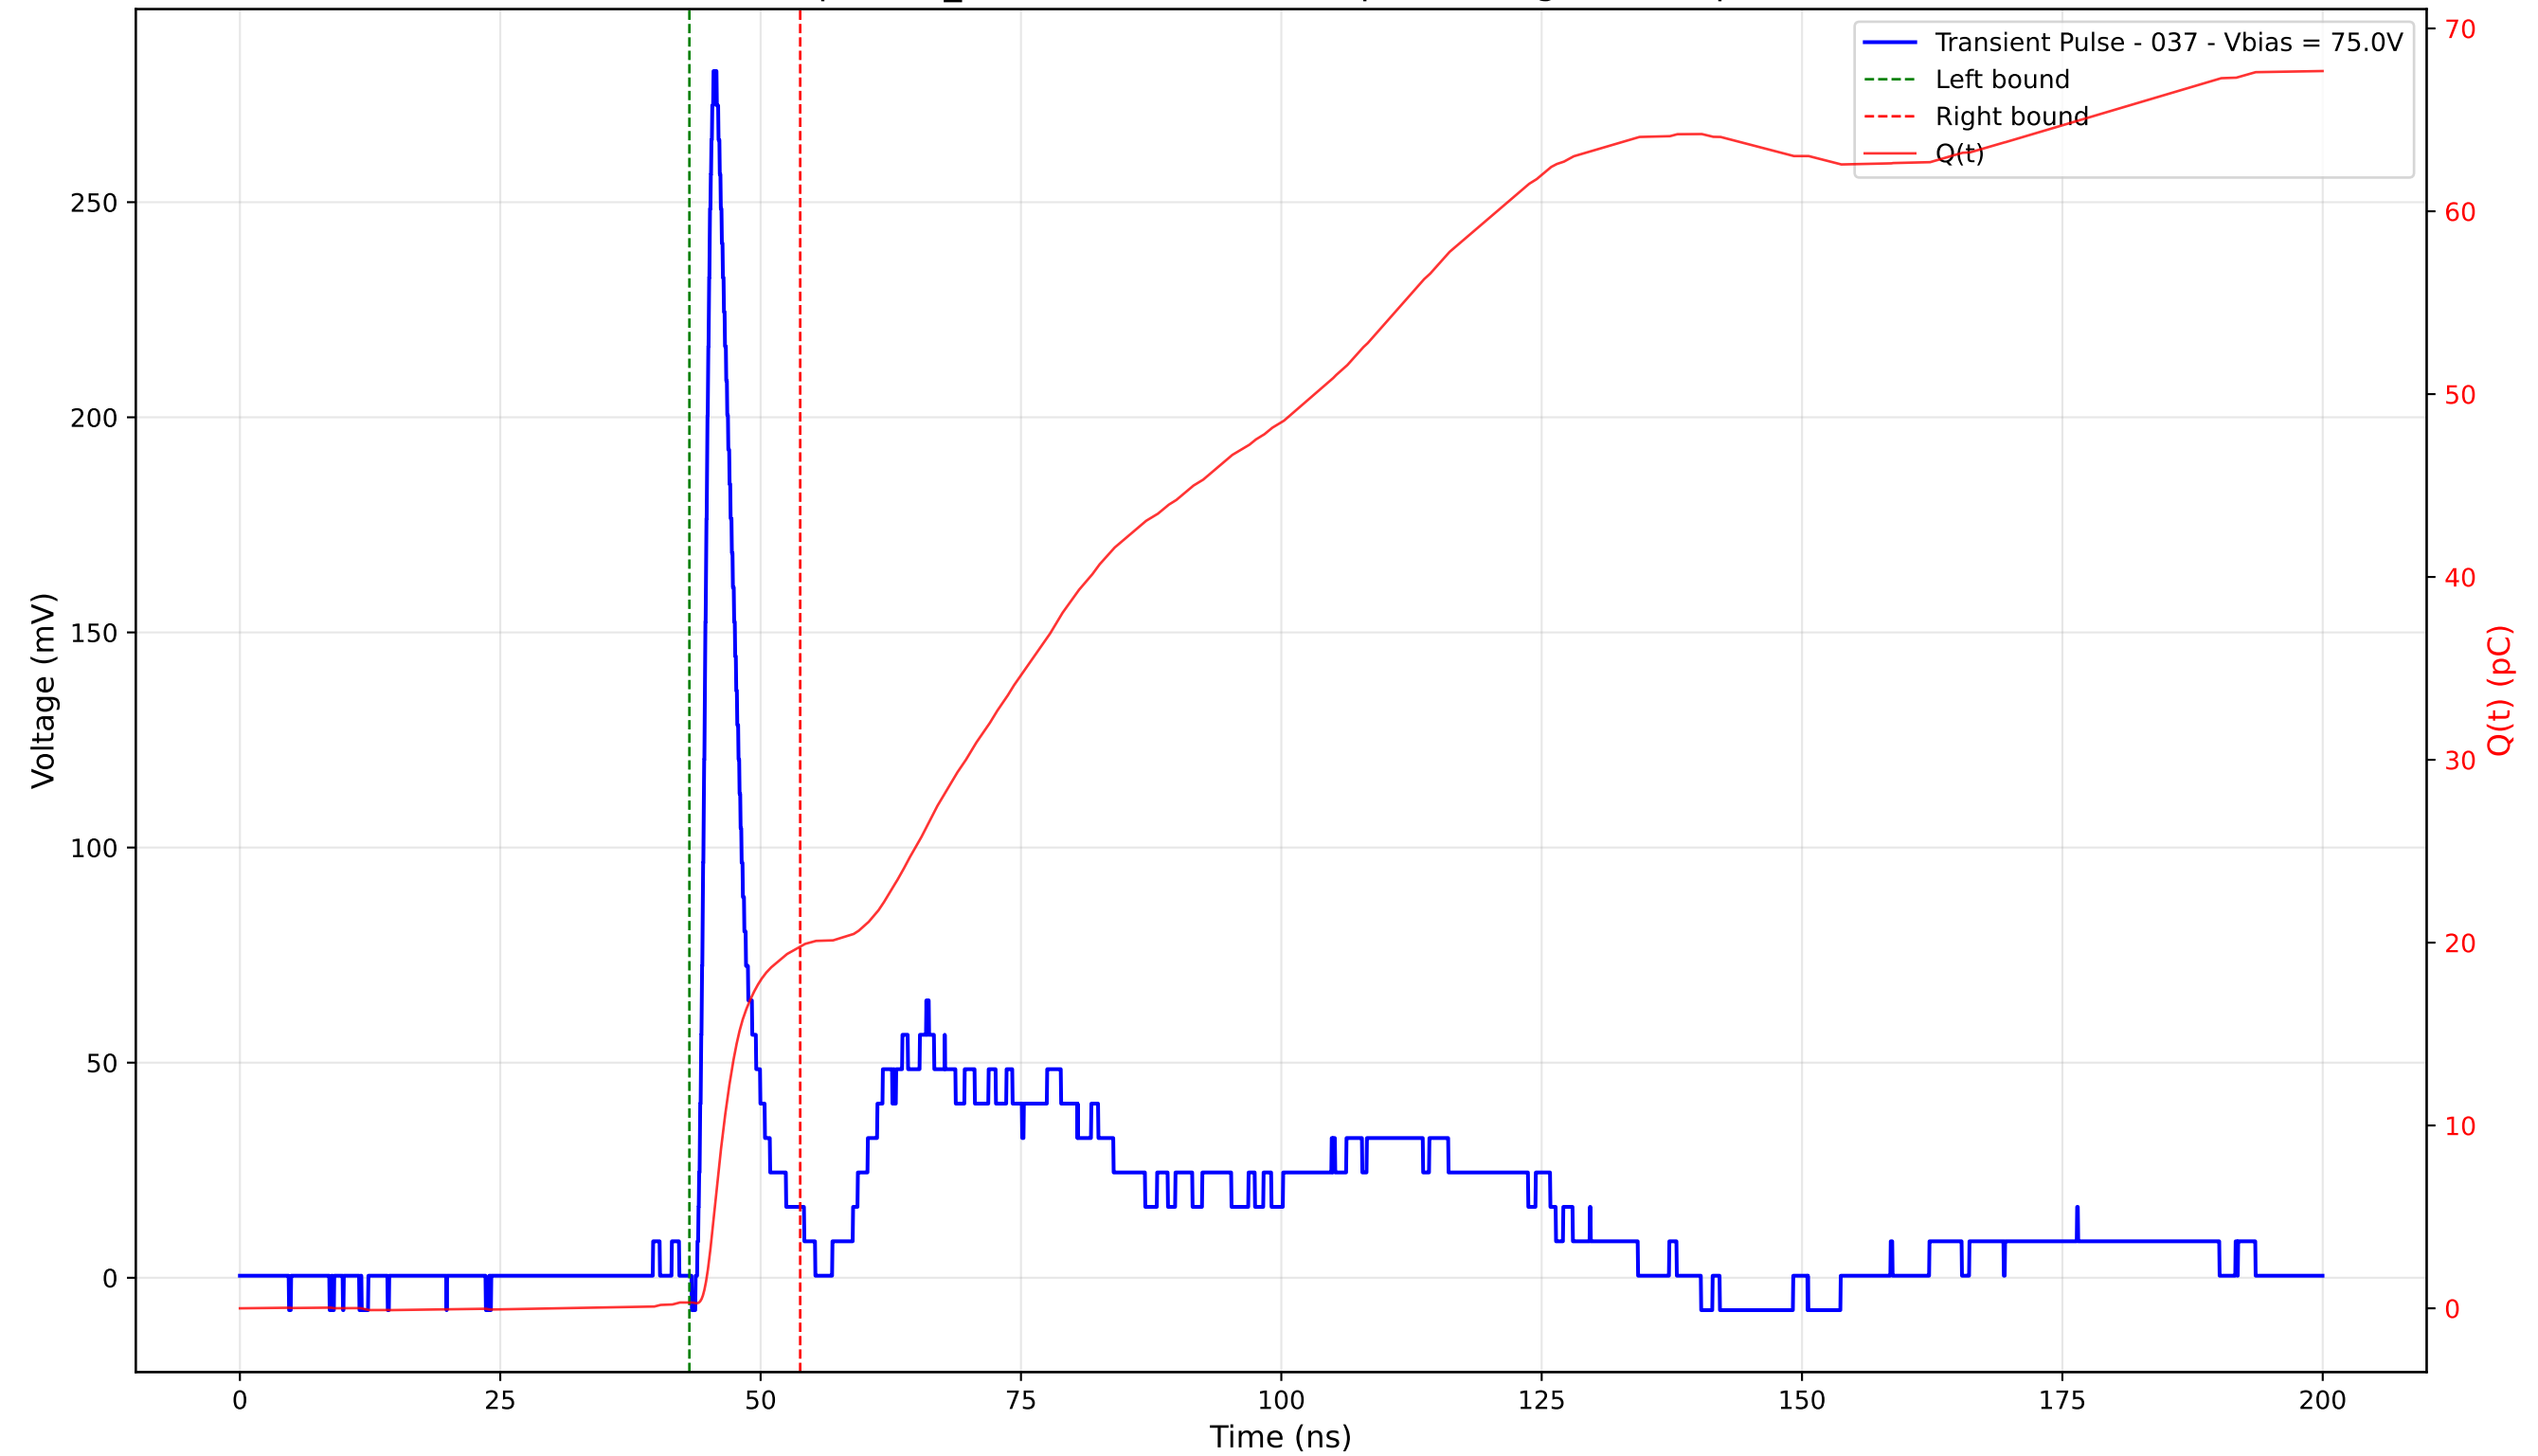


Transient Pulse - Sample: TD_4004 - Position: 305.0 μm - Charge: 19.78 pC - Rise Time: 1.05 ns

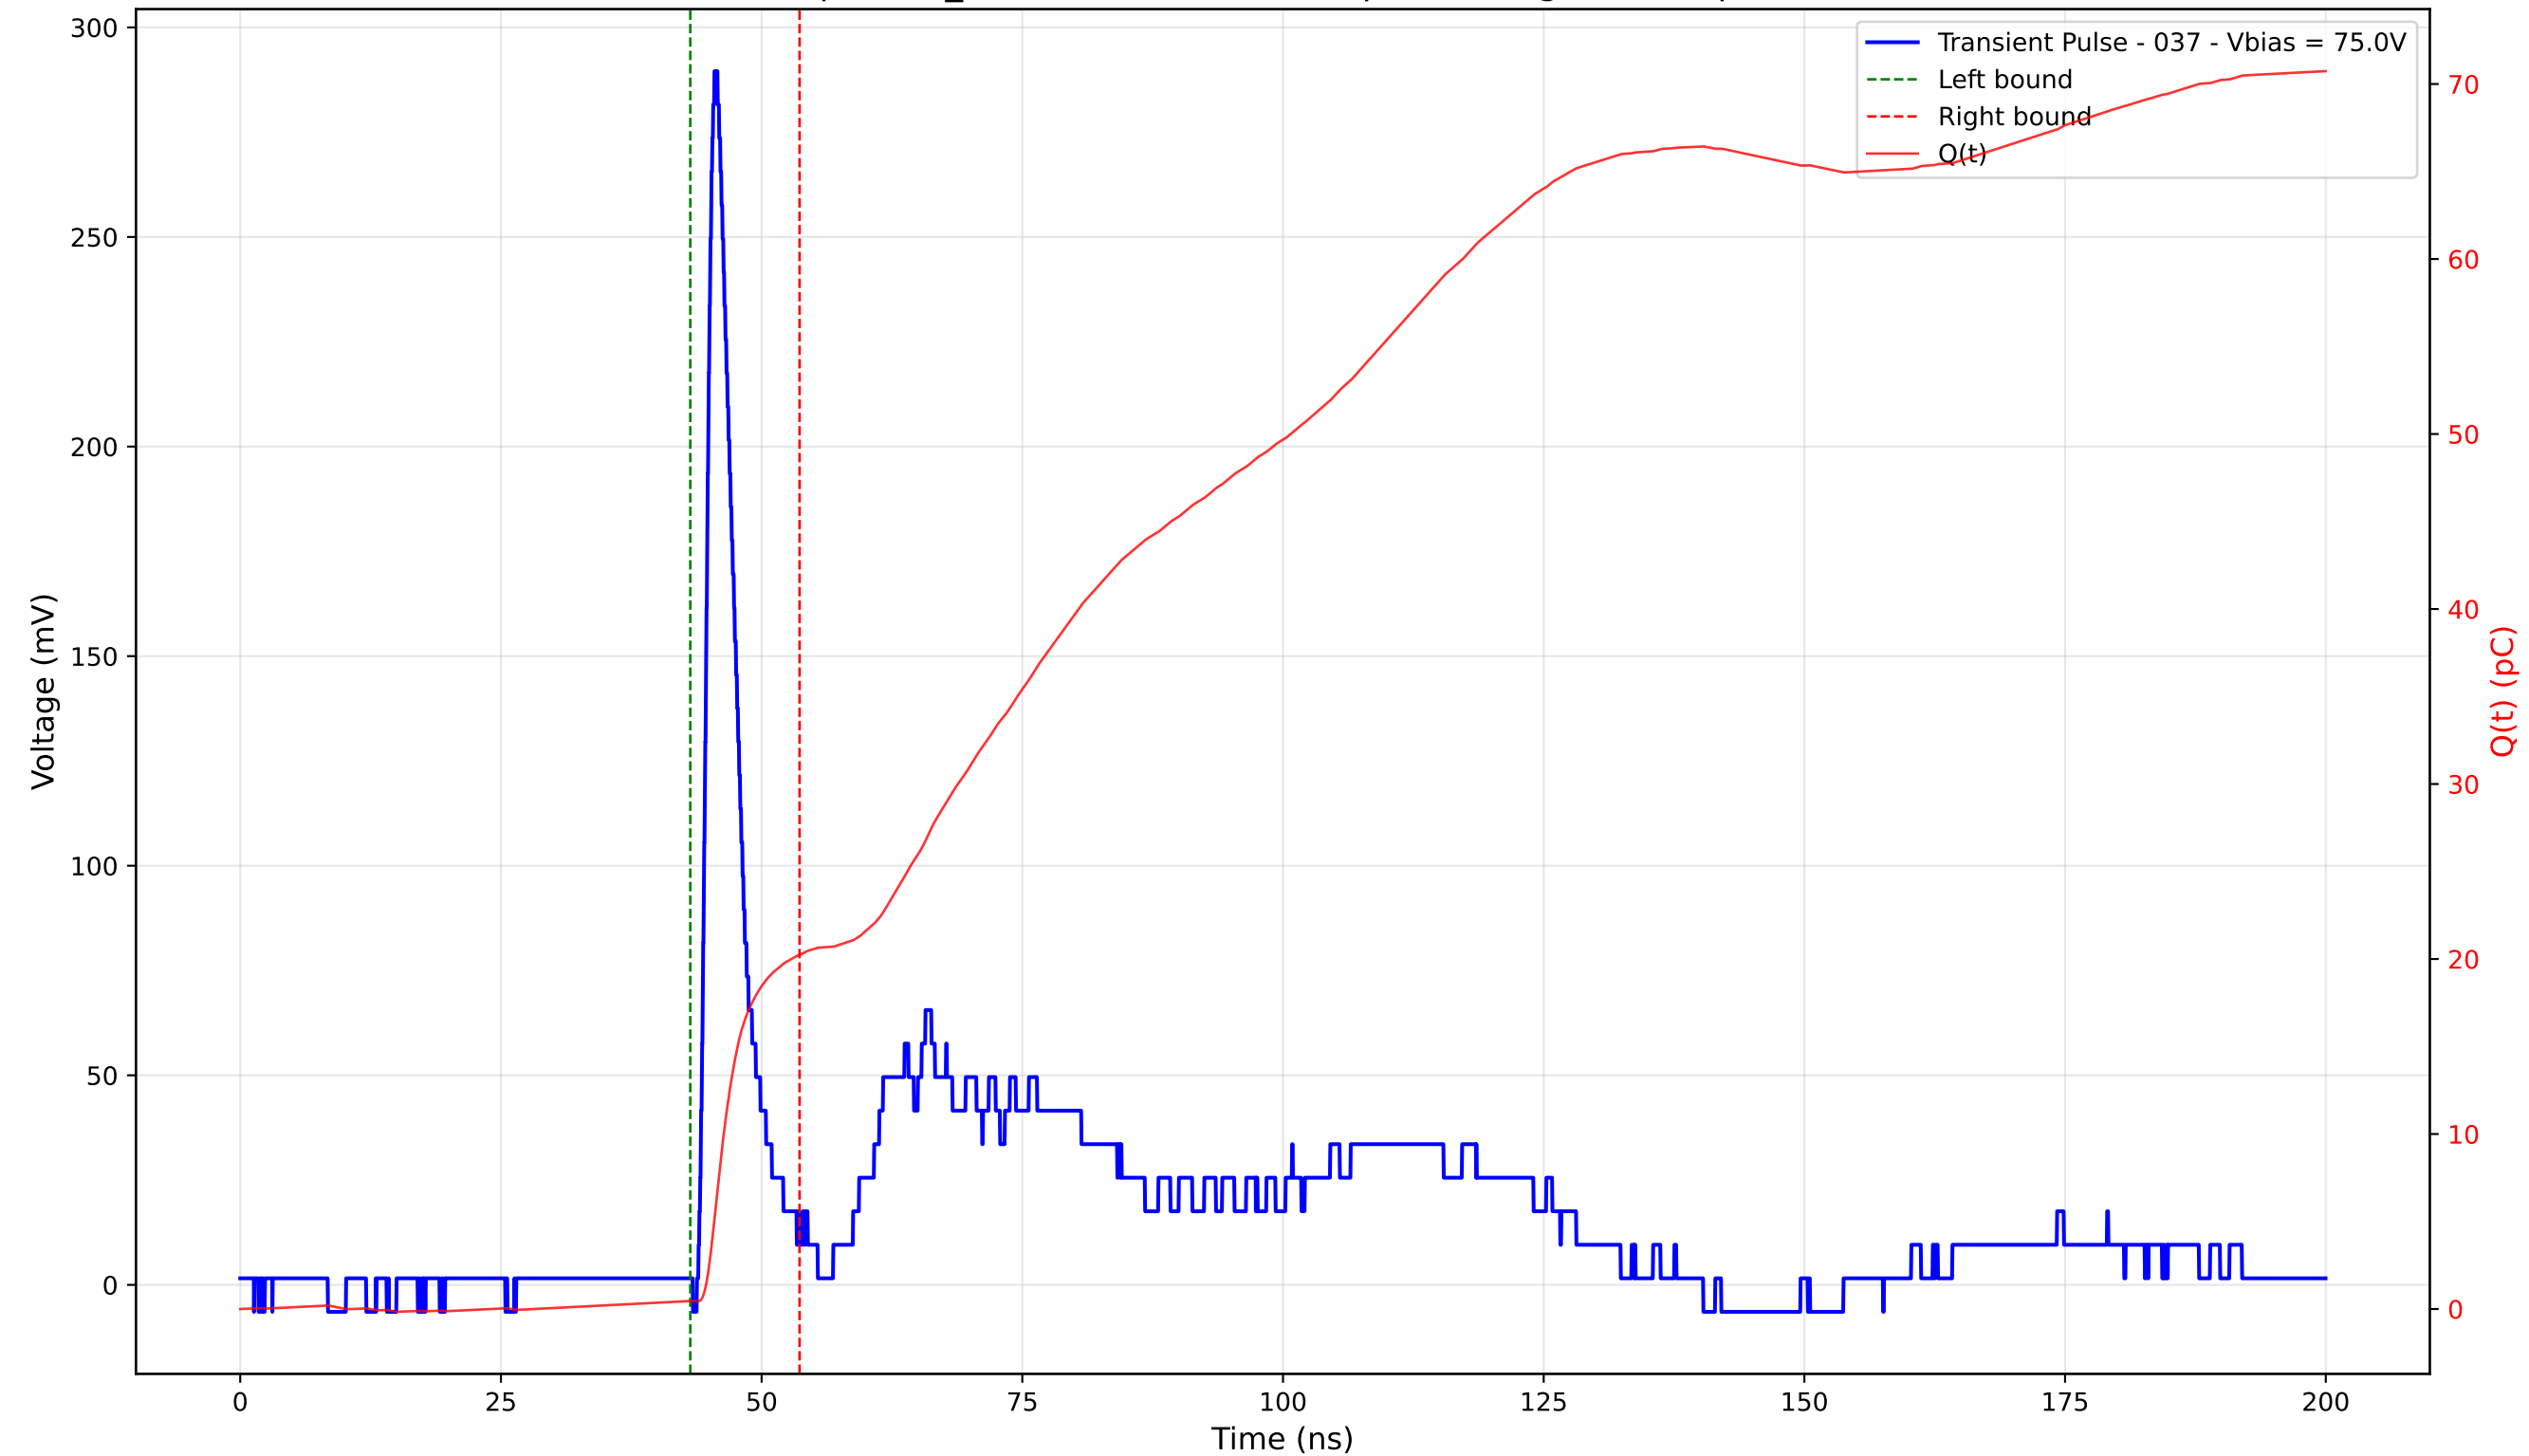


Transient Pulse - Sample: TD_4004 - Position: 310.0 μm - Charge: 18.94 pC - Rise Time: 1.06 ns

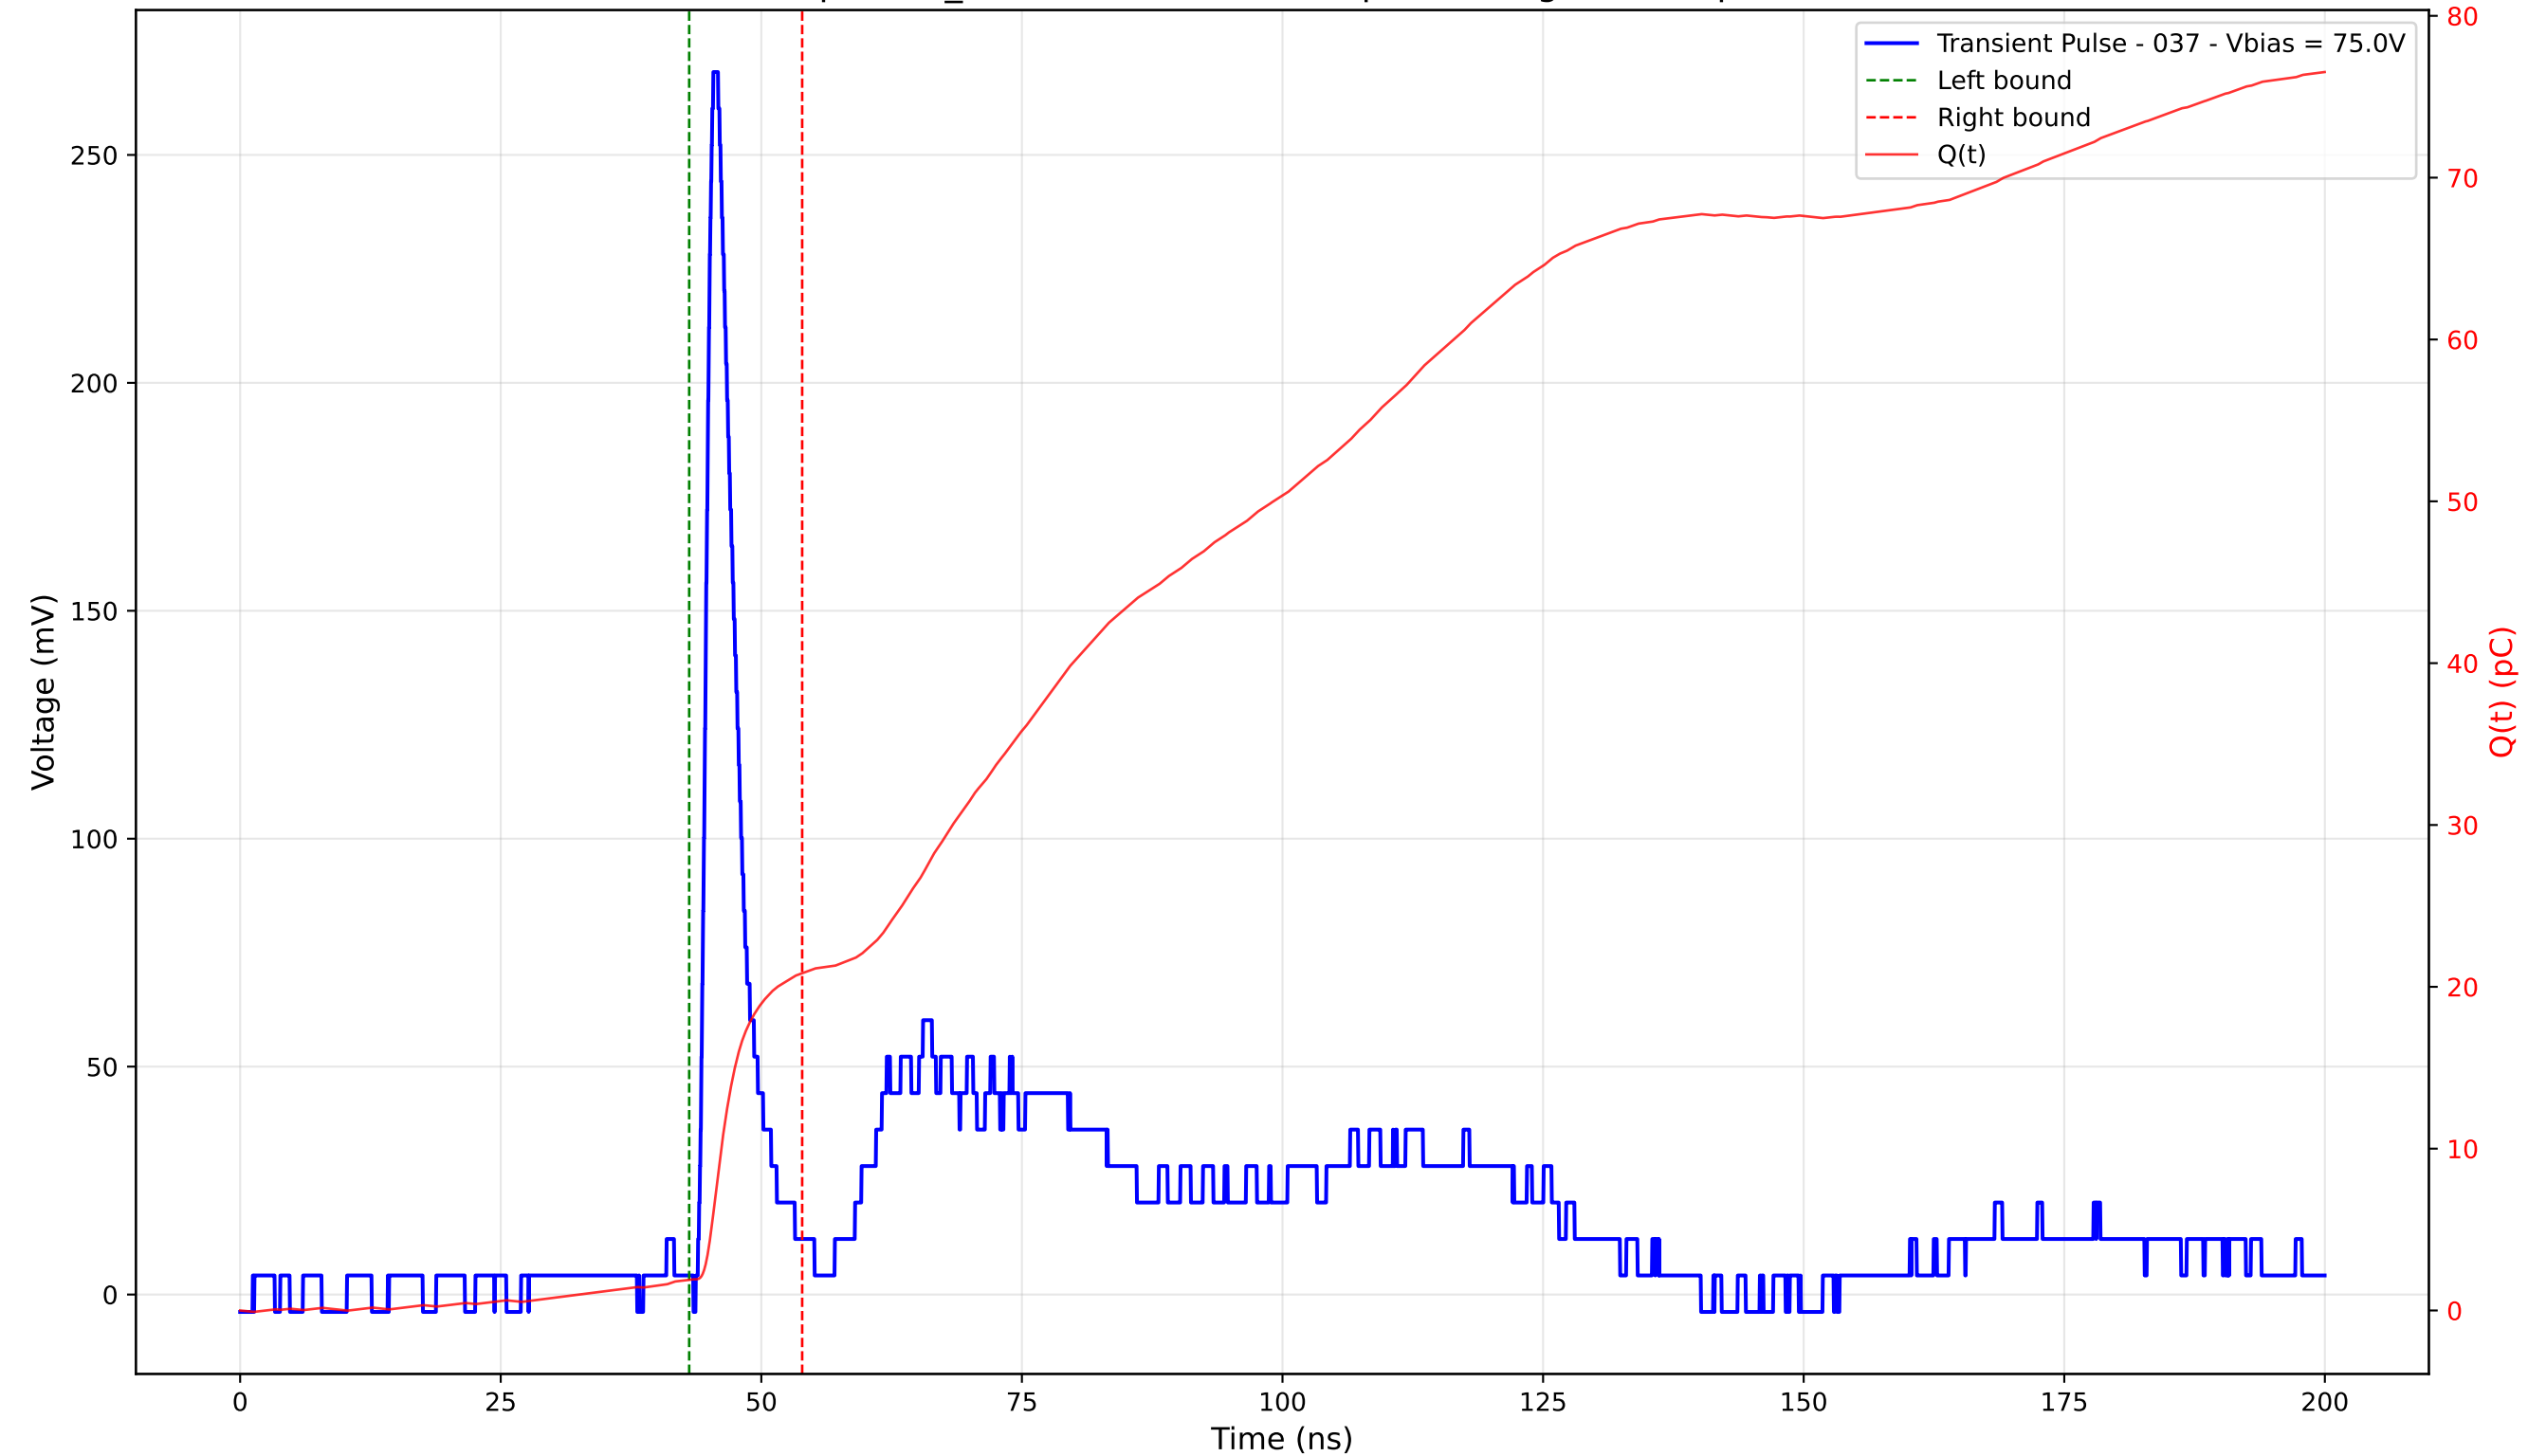


Transient Pulse - Sample: TD_4004 - Position: 315.0 μm - Charge: 16.61 pC - Rise Time: 1.06 ns

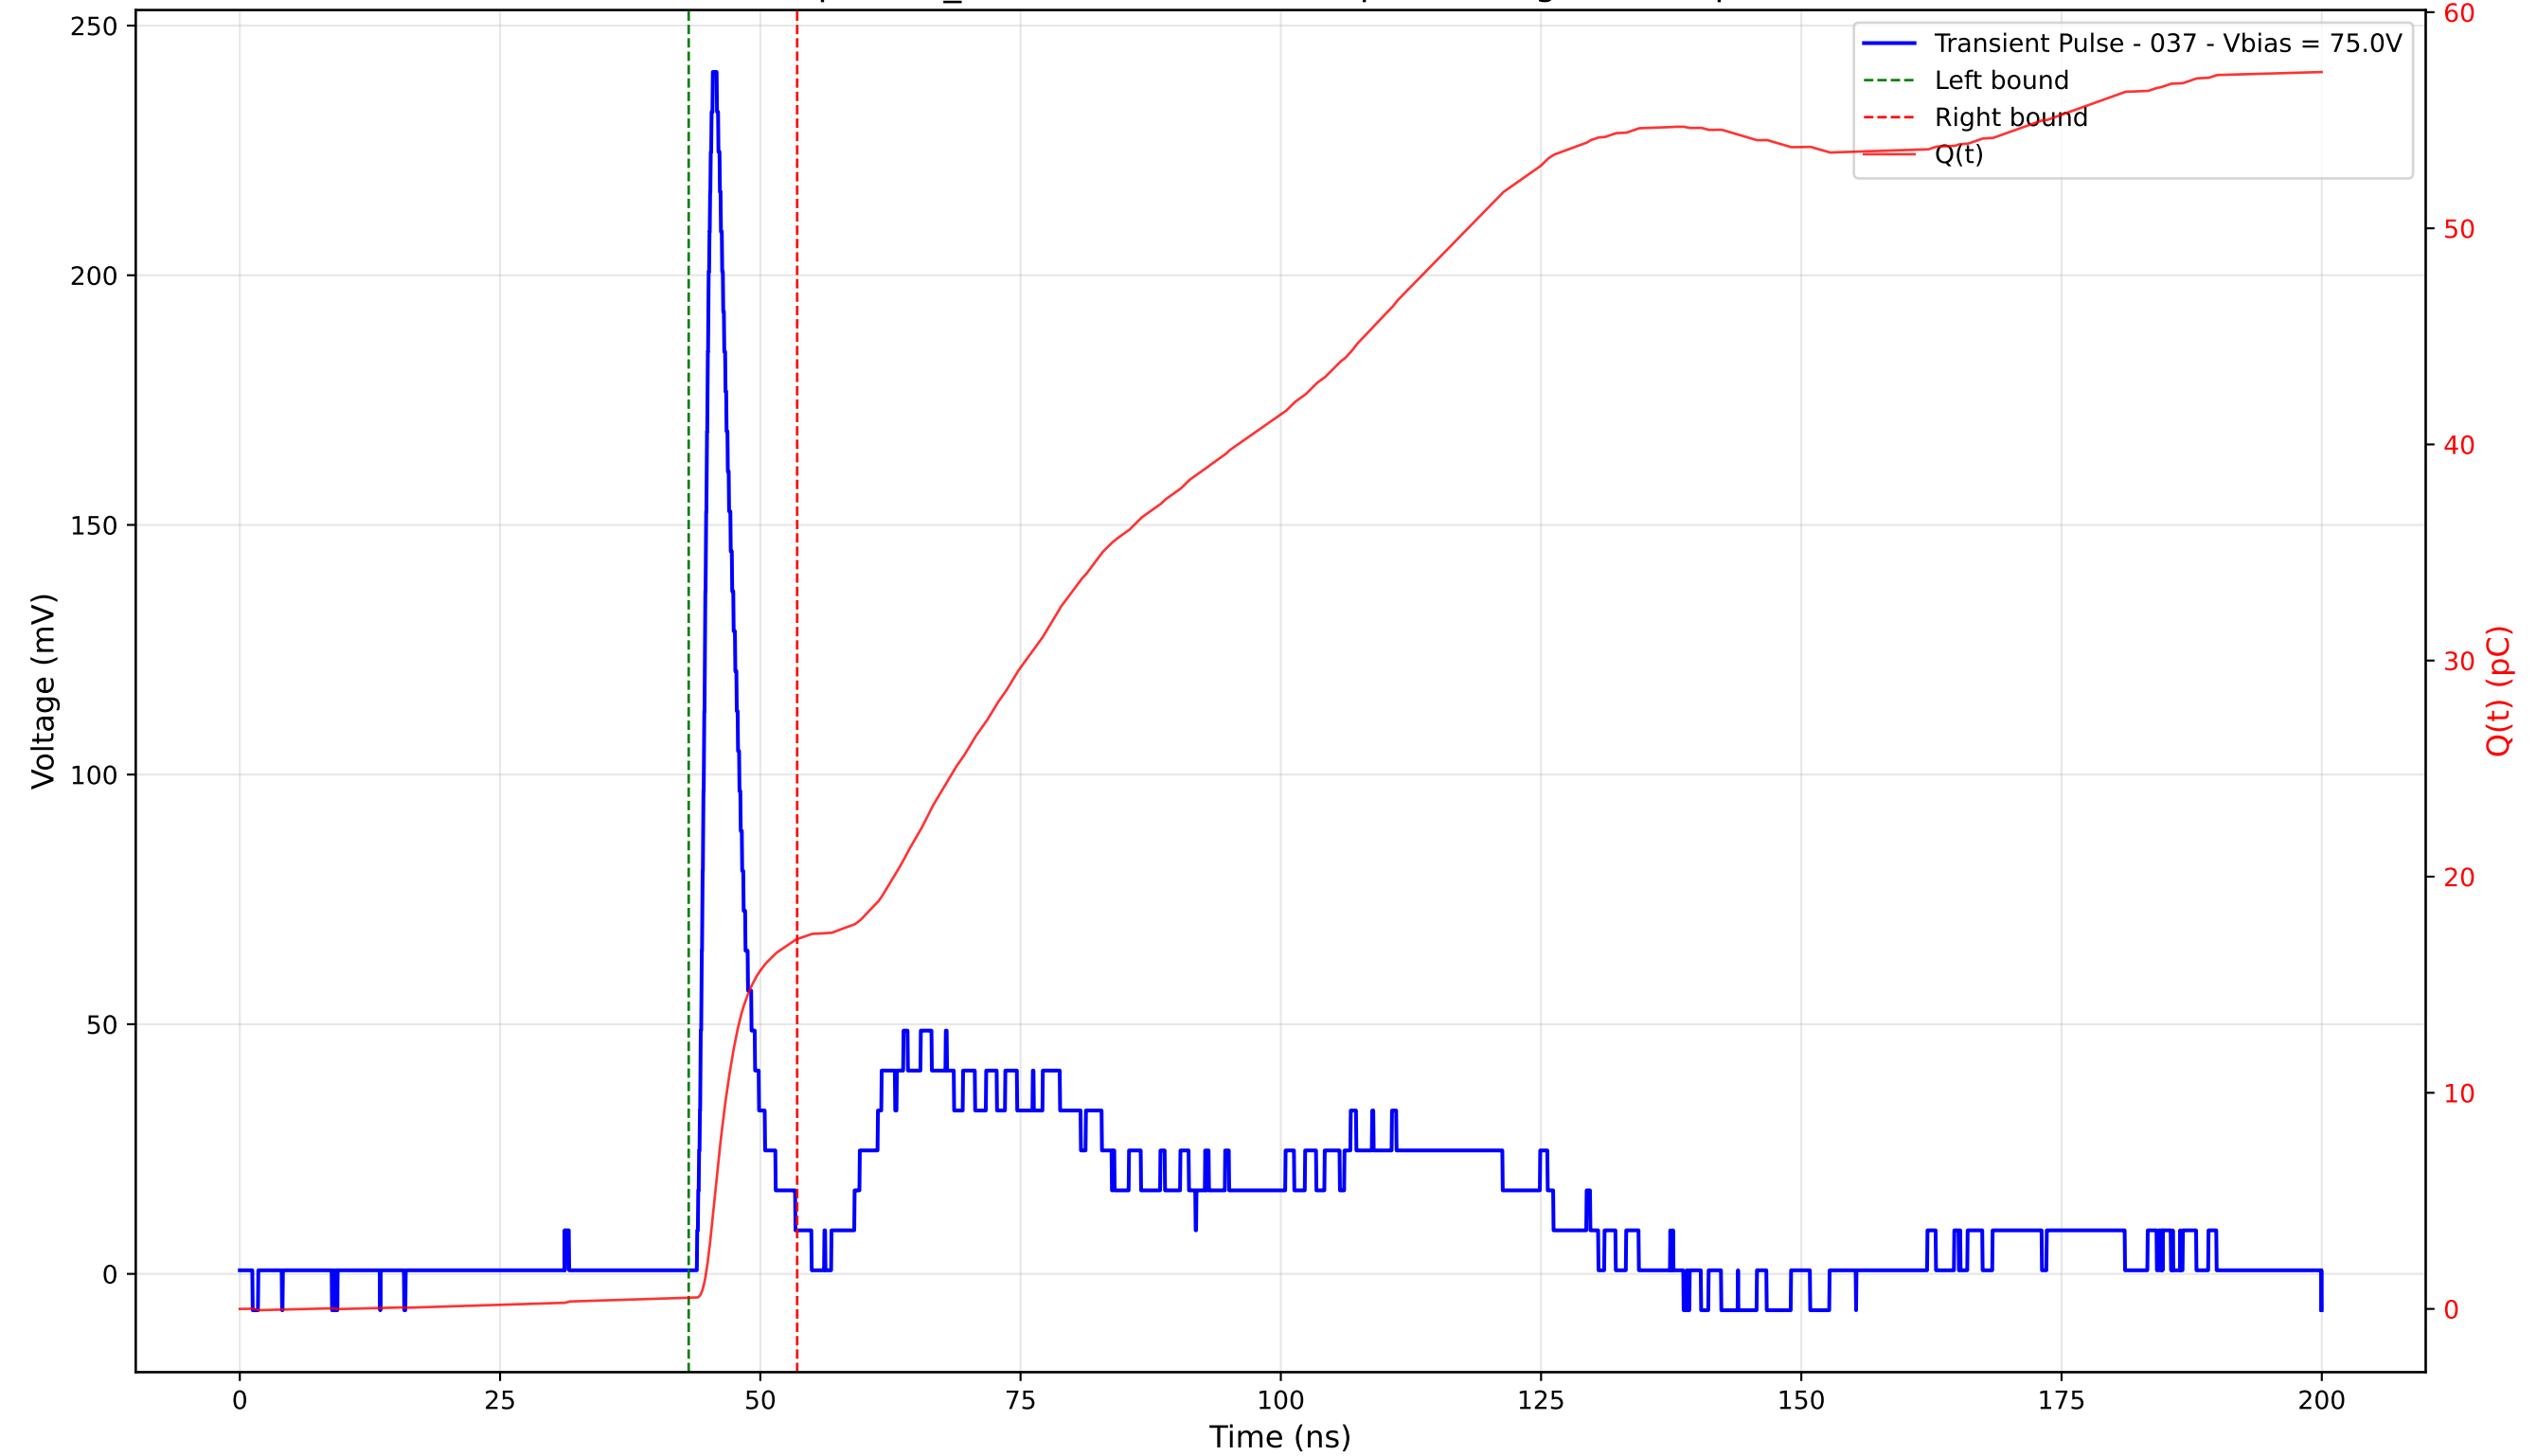


Transient Pulse - Sample: TD_4004 - Position: 320.0 μm - Charge: 16.51 pC - Rise Time: 1.07 ns

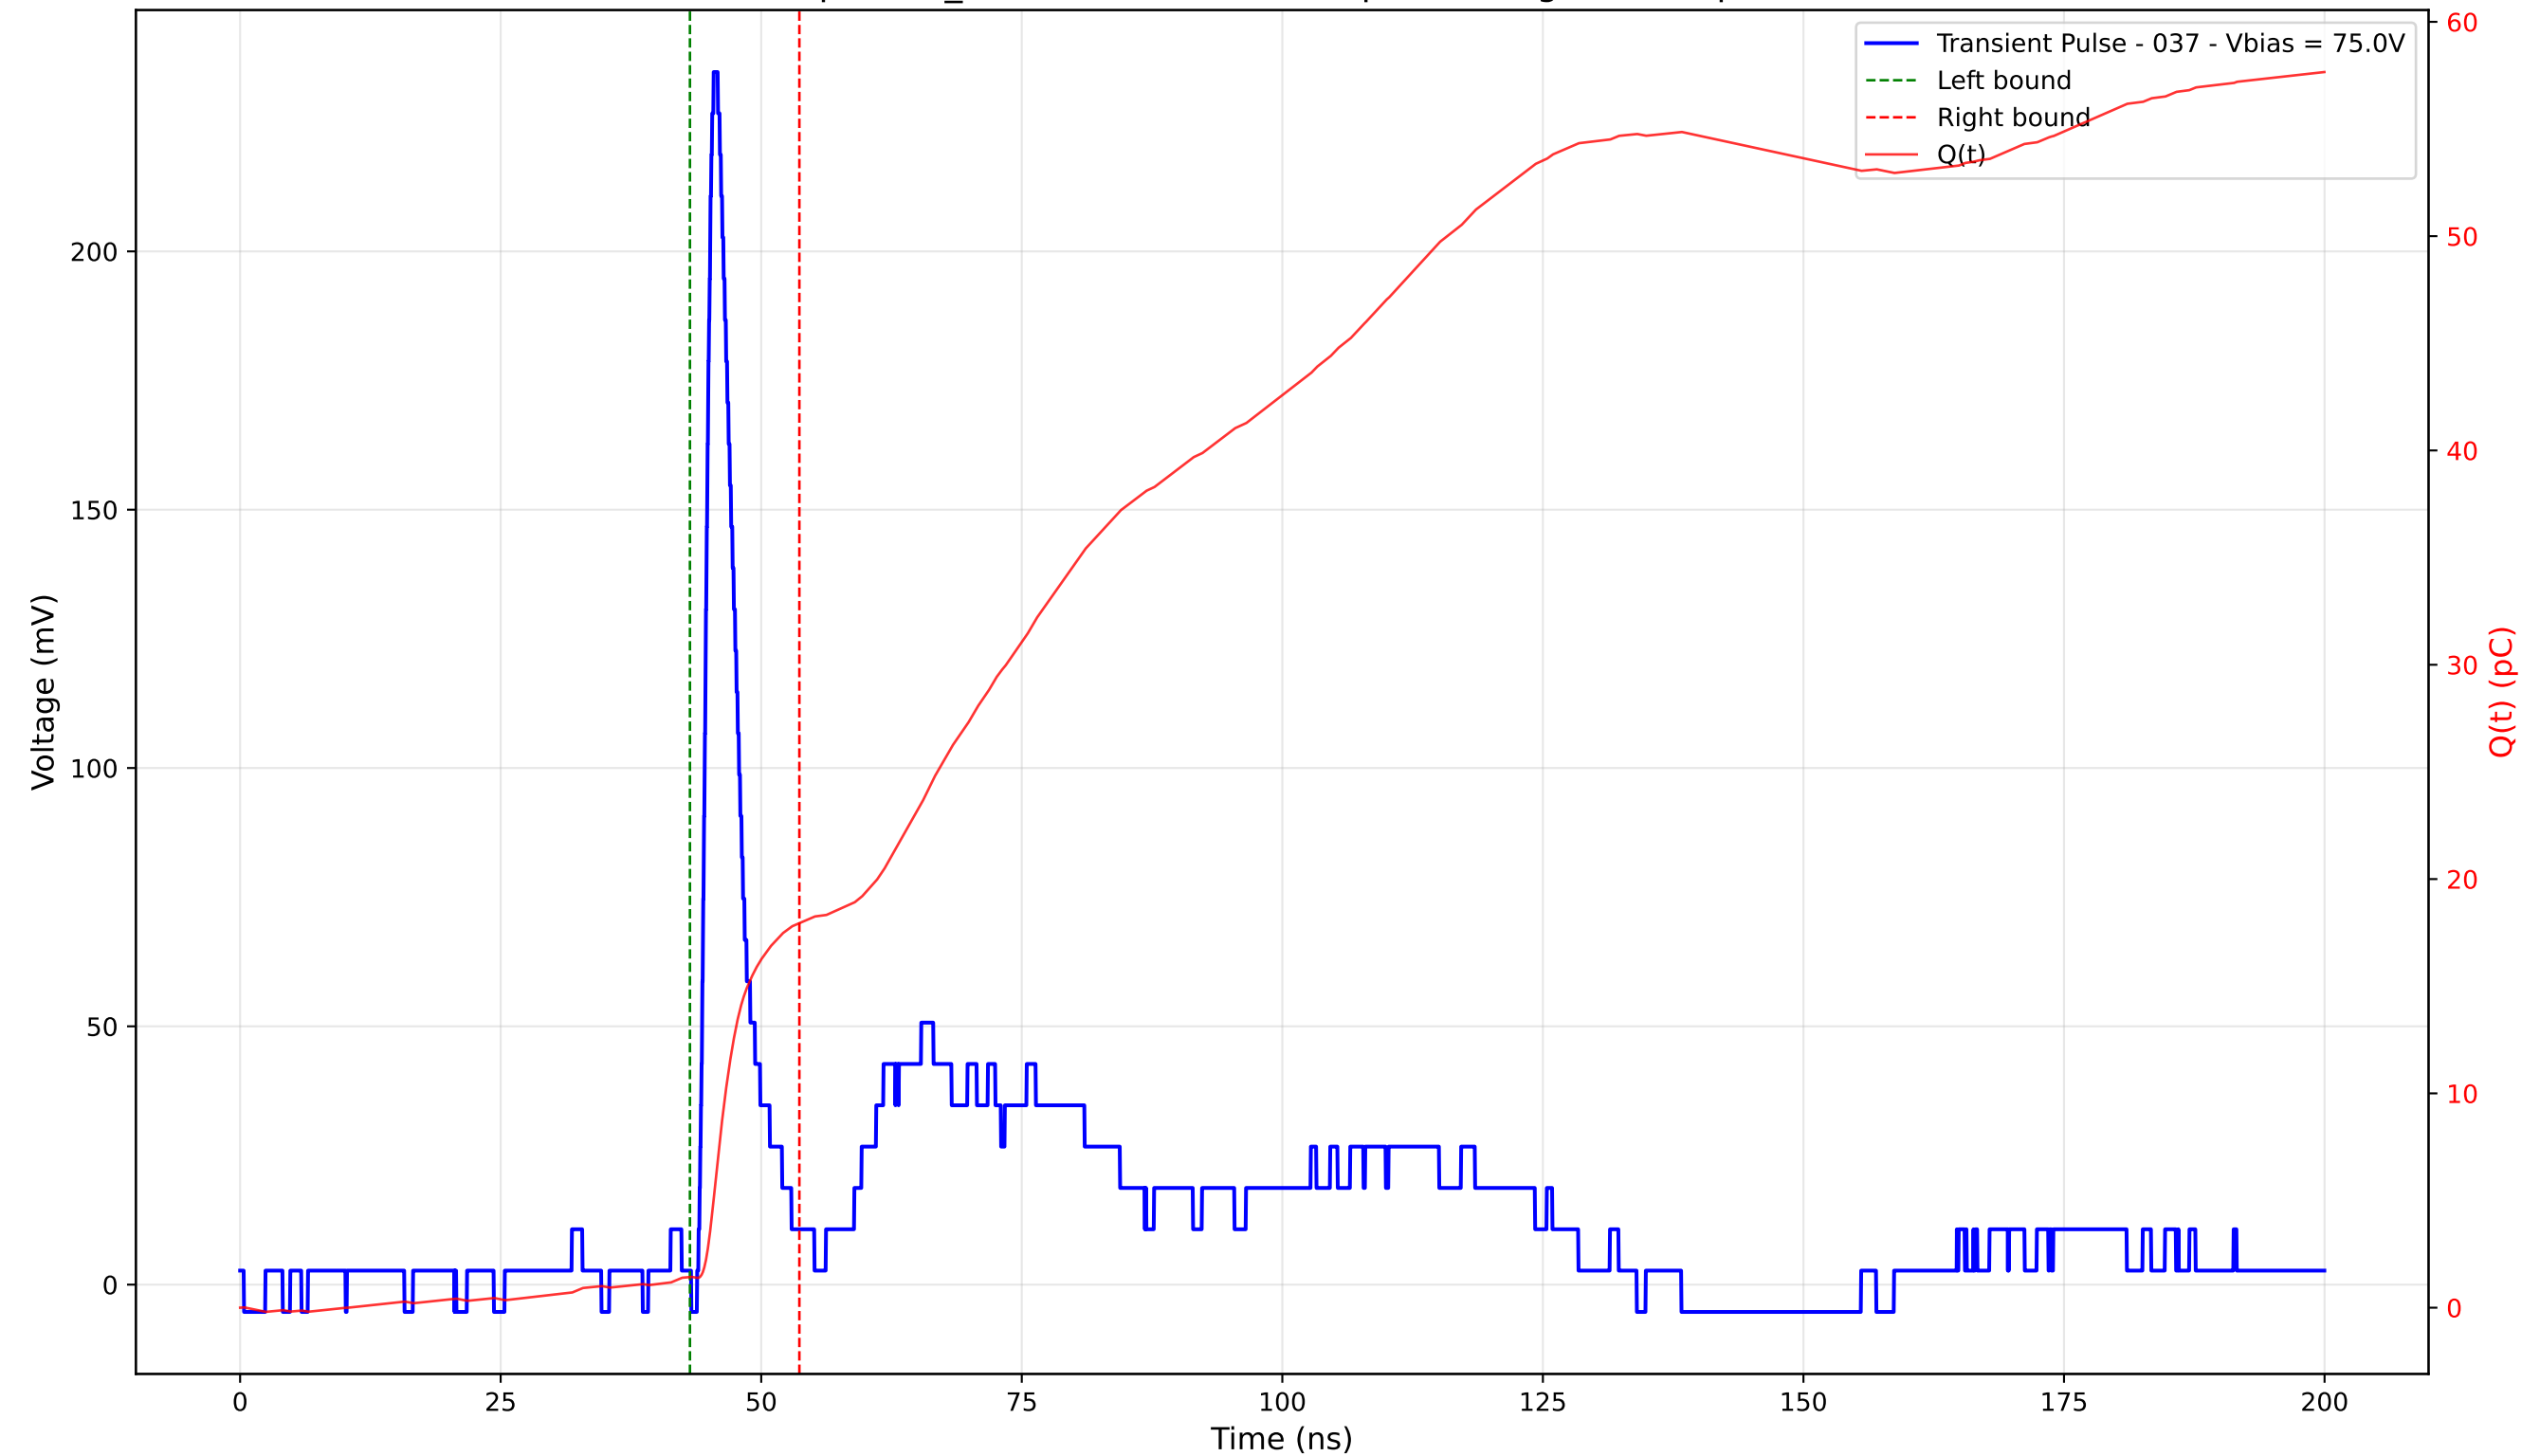


Transient Pulse - Sample: TD_4004 - Position: 325.0 μm - Charge: 16.06 pC - Rise Time: 1.13 ns

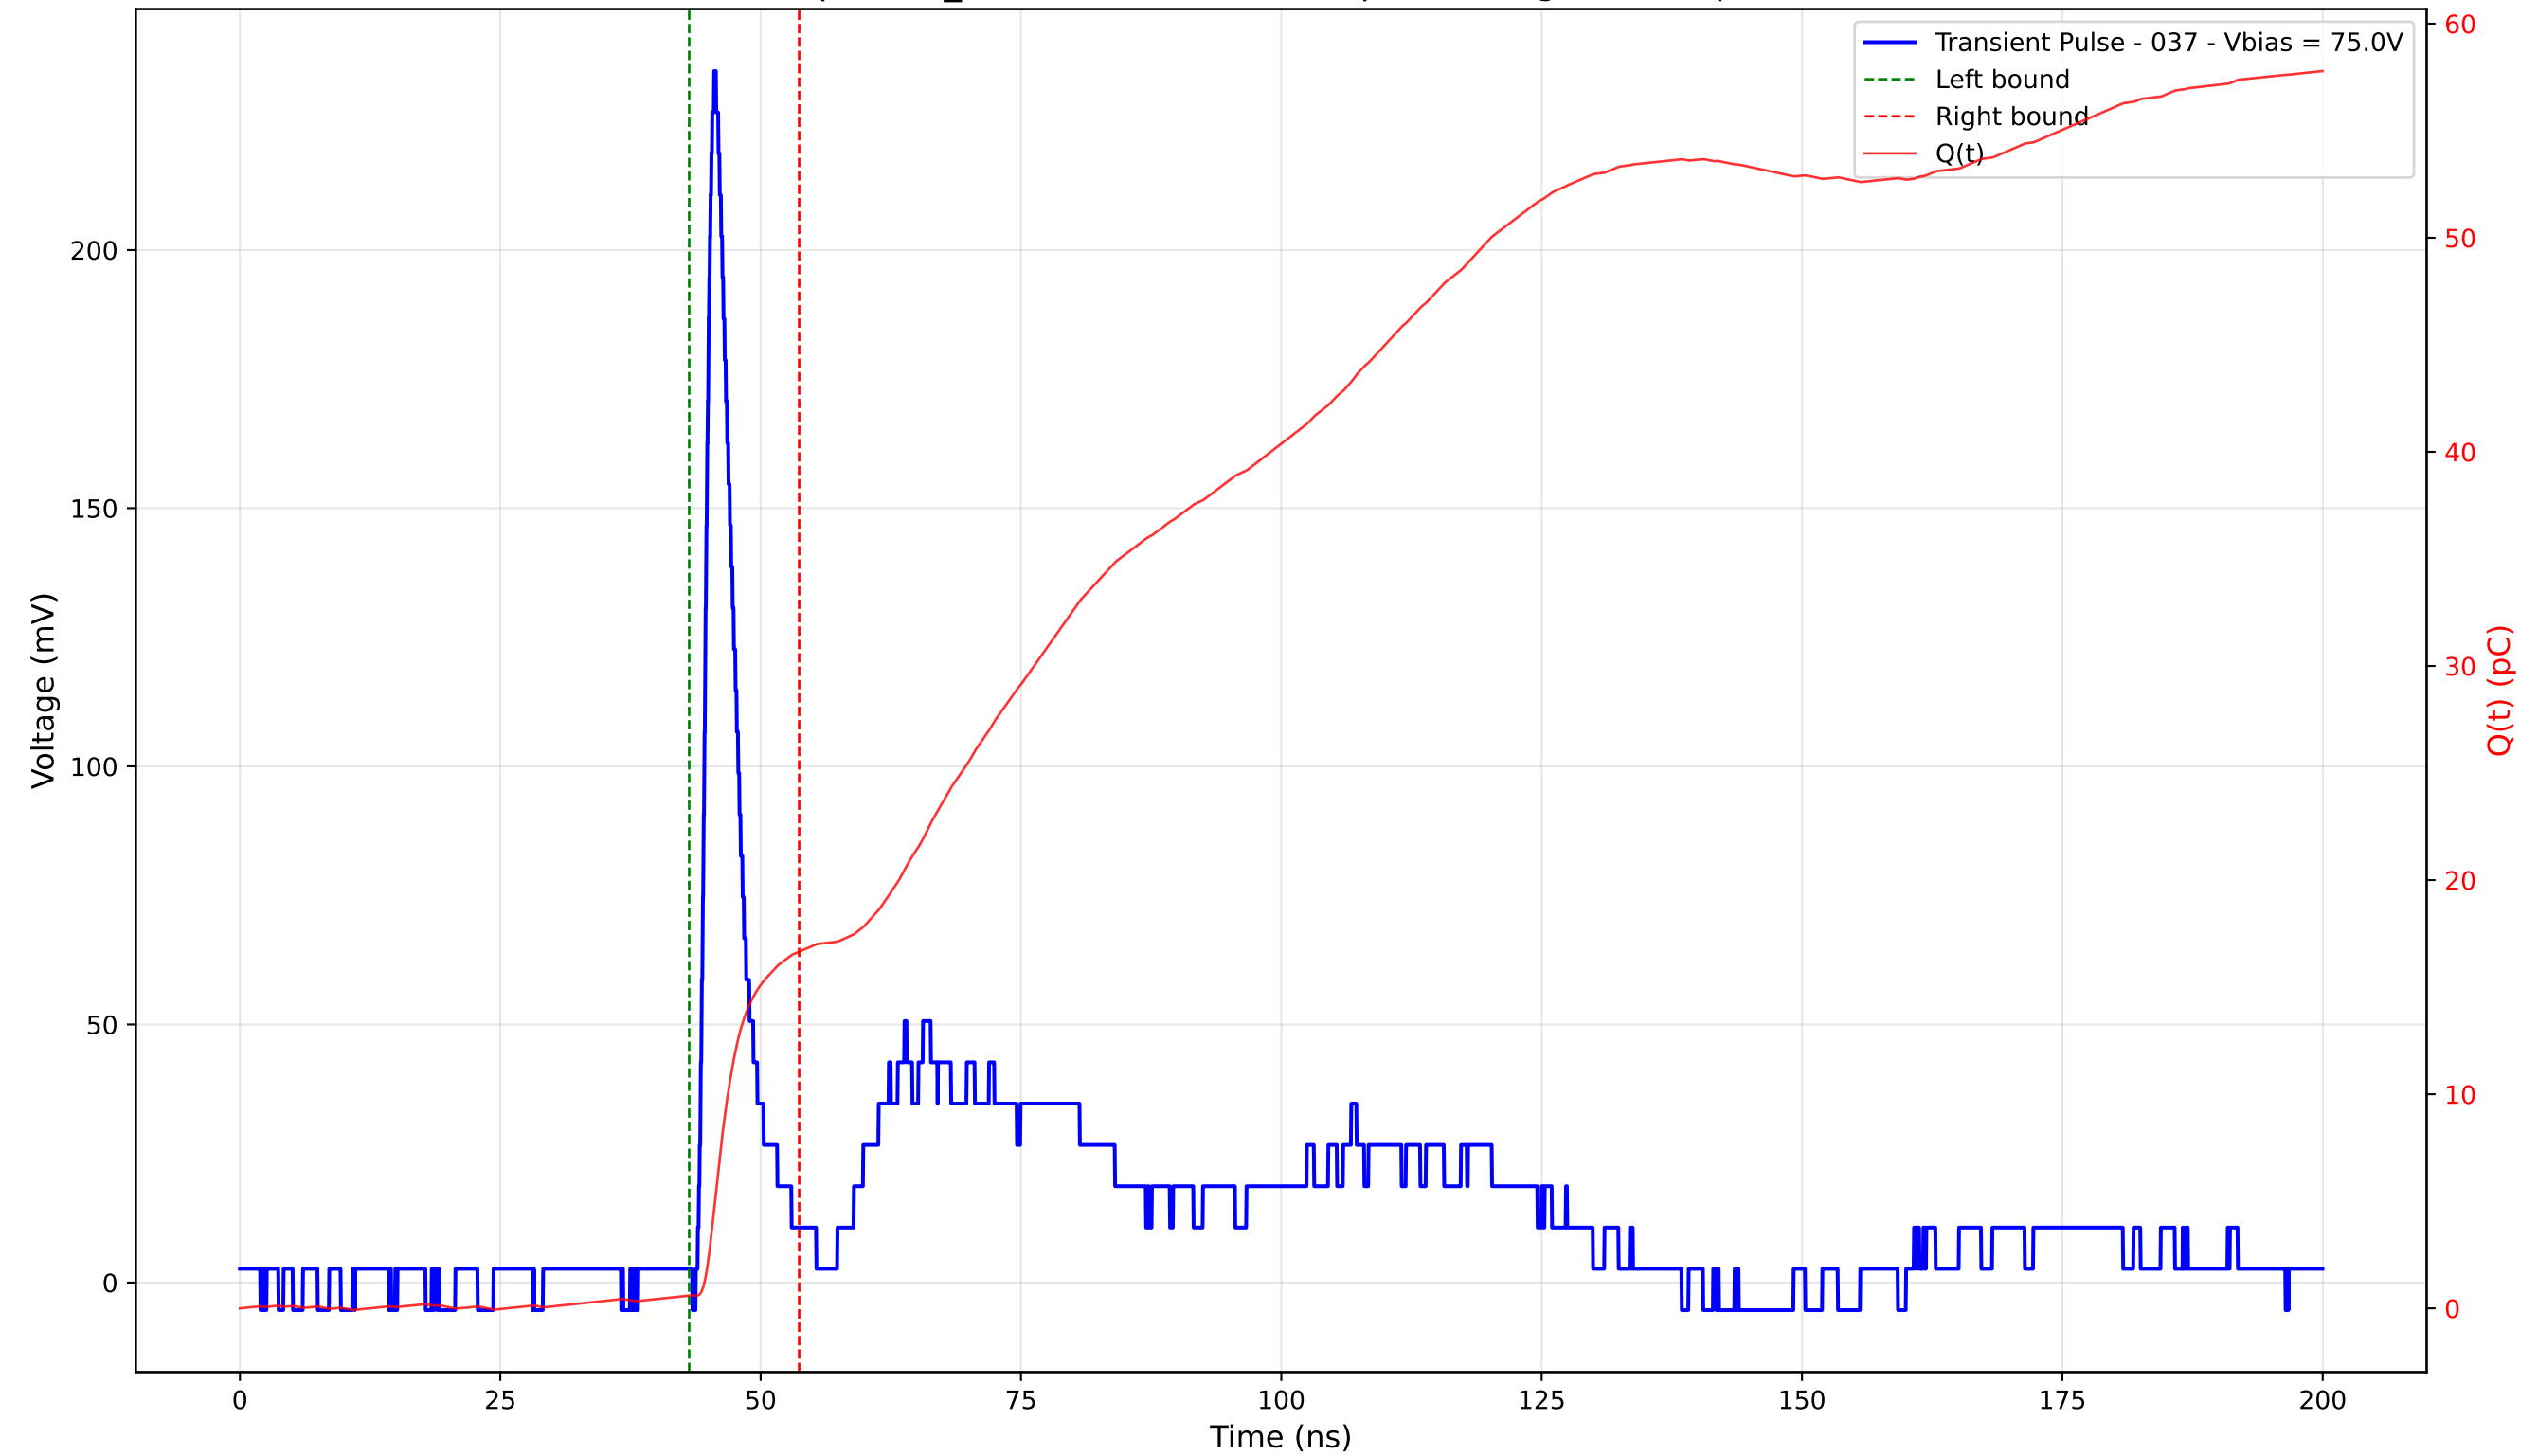


Transient Pulse - Sample: TD_4004 - Position: 330.0 μm - Charge: 14.49 pC - Rise Time: 1.11 ns

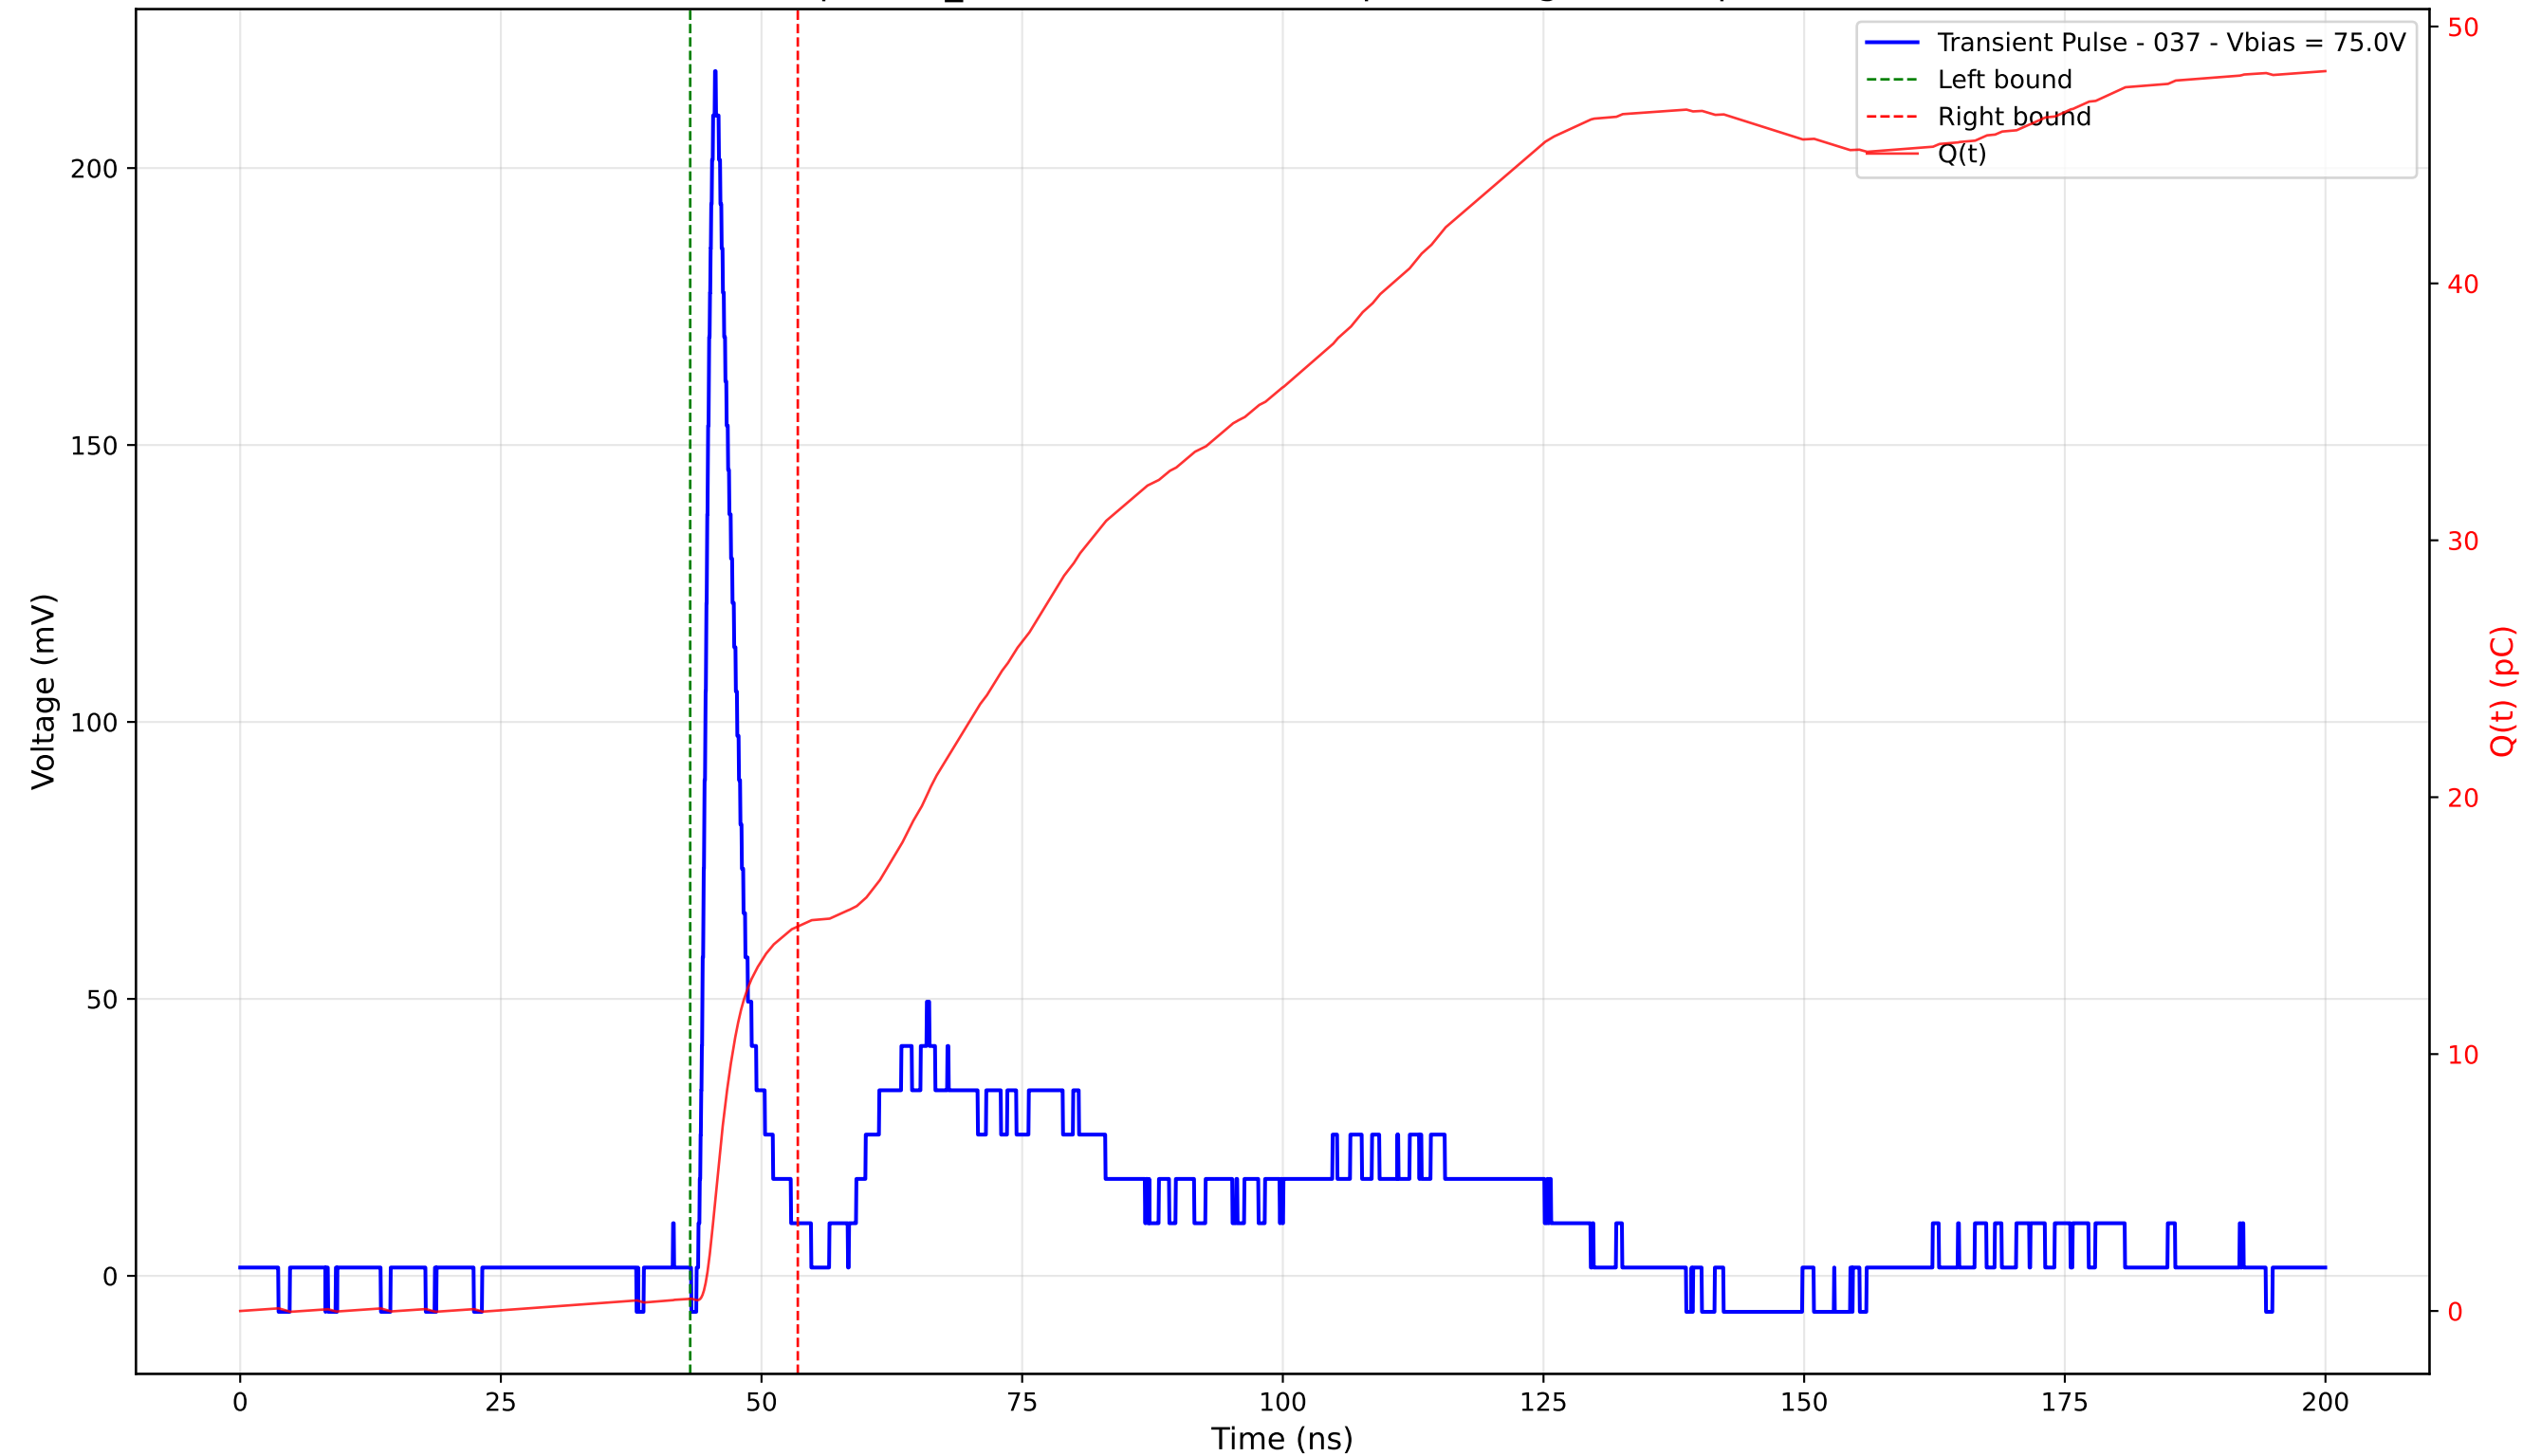


Transient Pulse - Sample: TD_4004 - Position: 335.0 μm - Charge: 13.41 pC - Rise Time: 1.10 ns

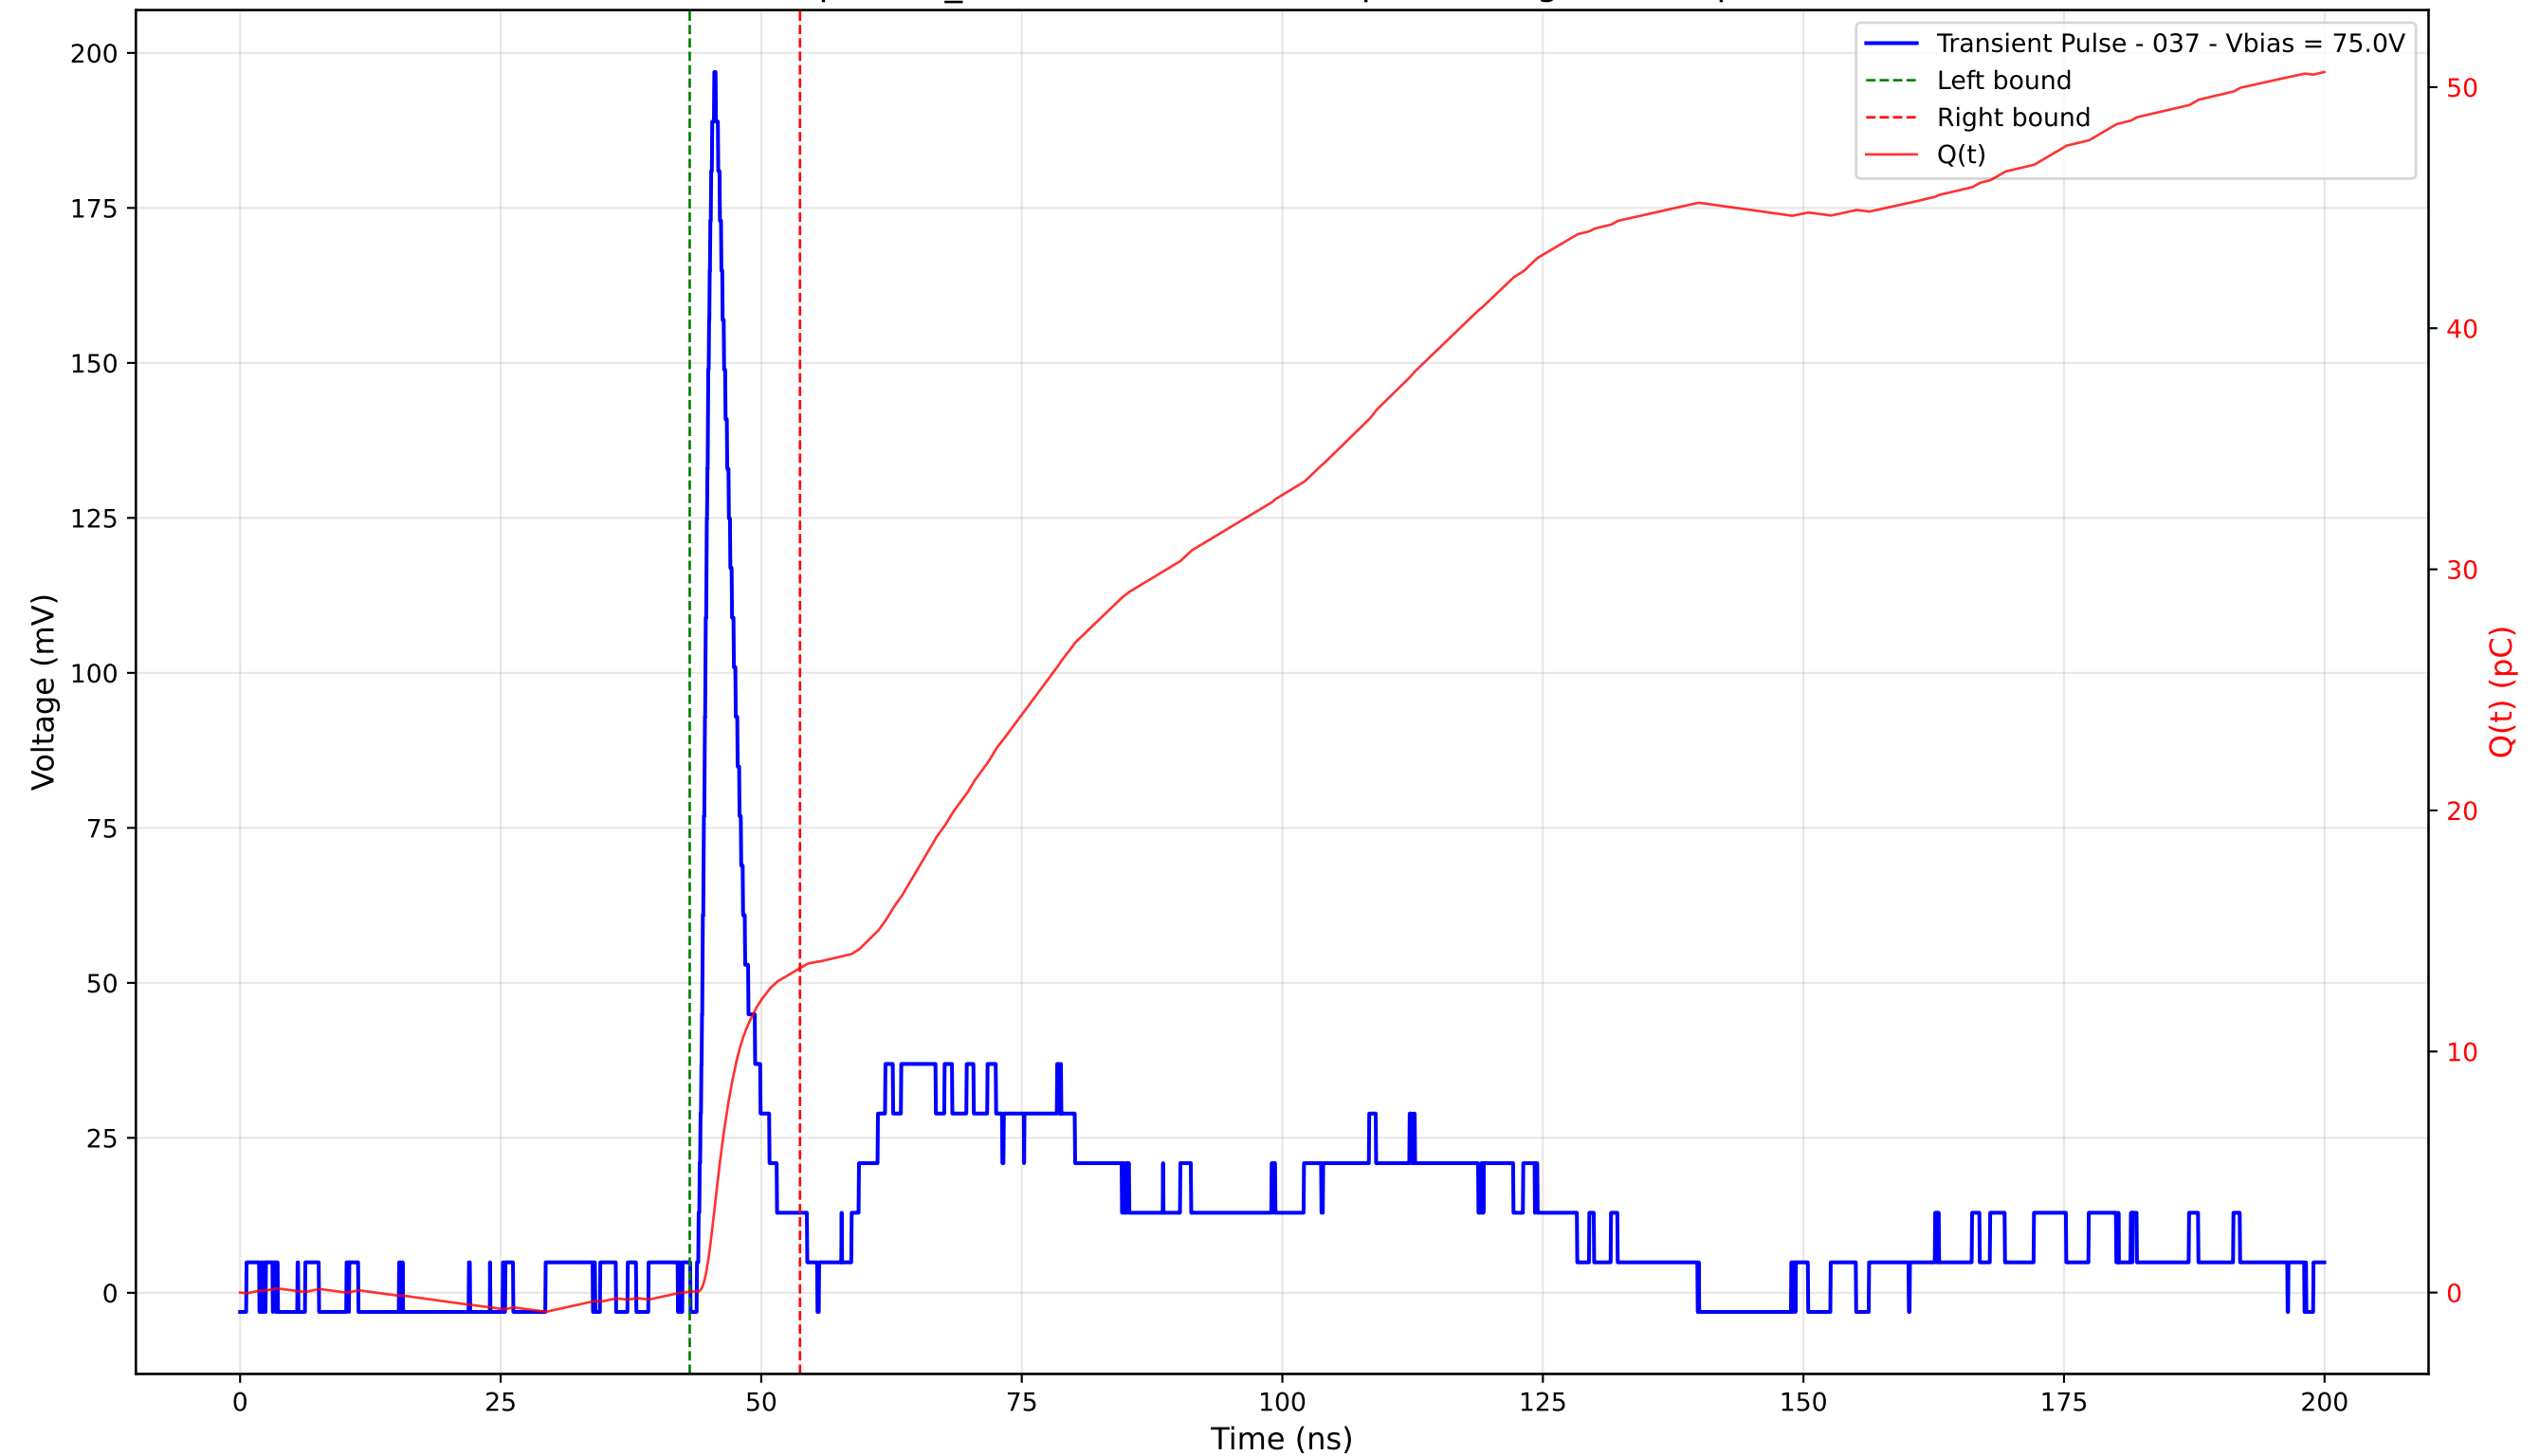


Transient Pulse - Sample: TD_4004 - Position: 340.0 μm - Charge: 13.91 pC - Rise Time: 1.12 ns

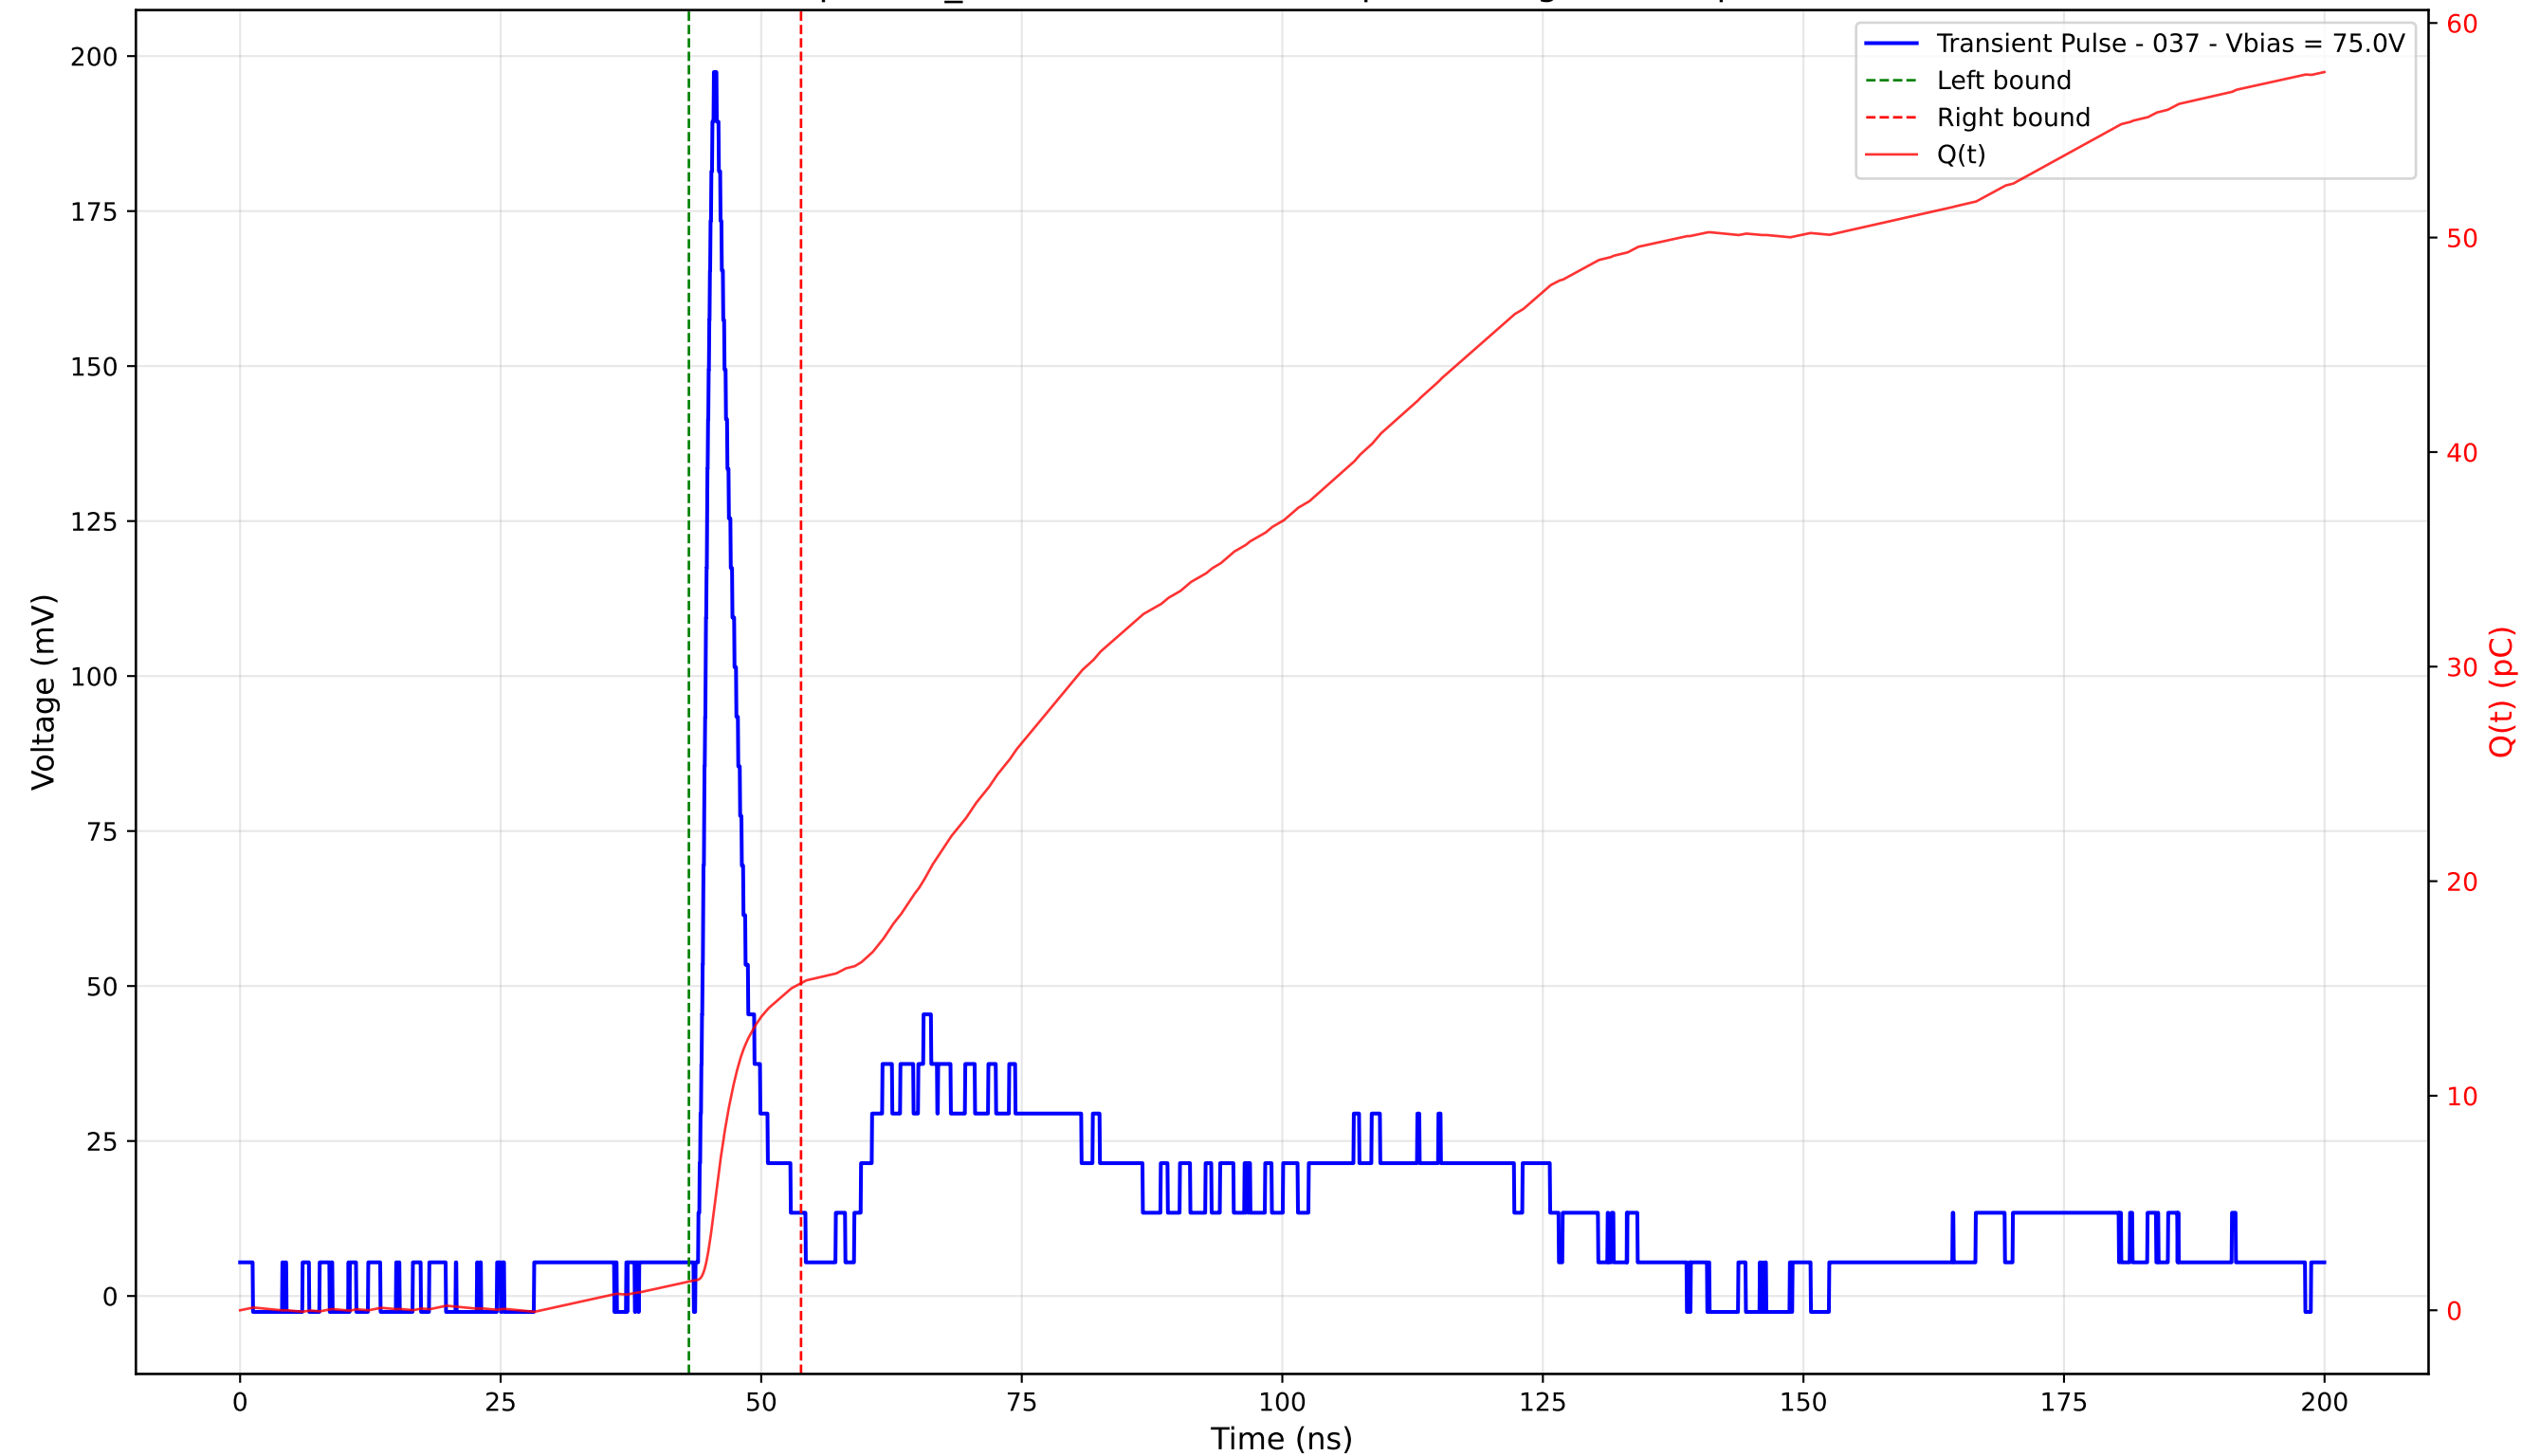


Transient Pulse - Sample: TD_4004 - Position: 345.0 μm - Charge: 13.86 pC - Rise Time: 1.06 ns

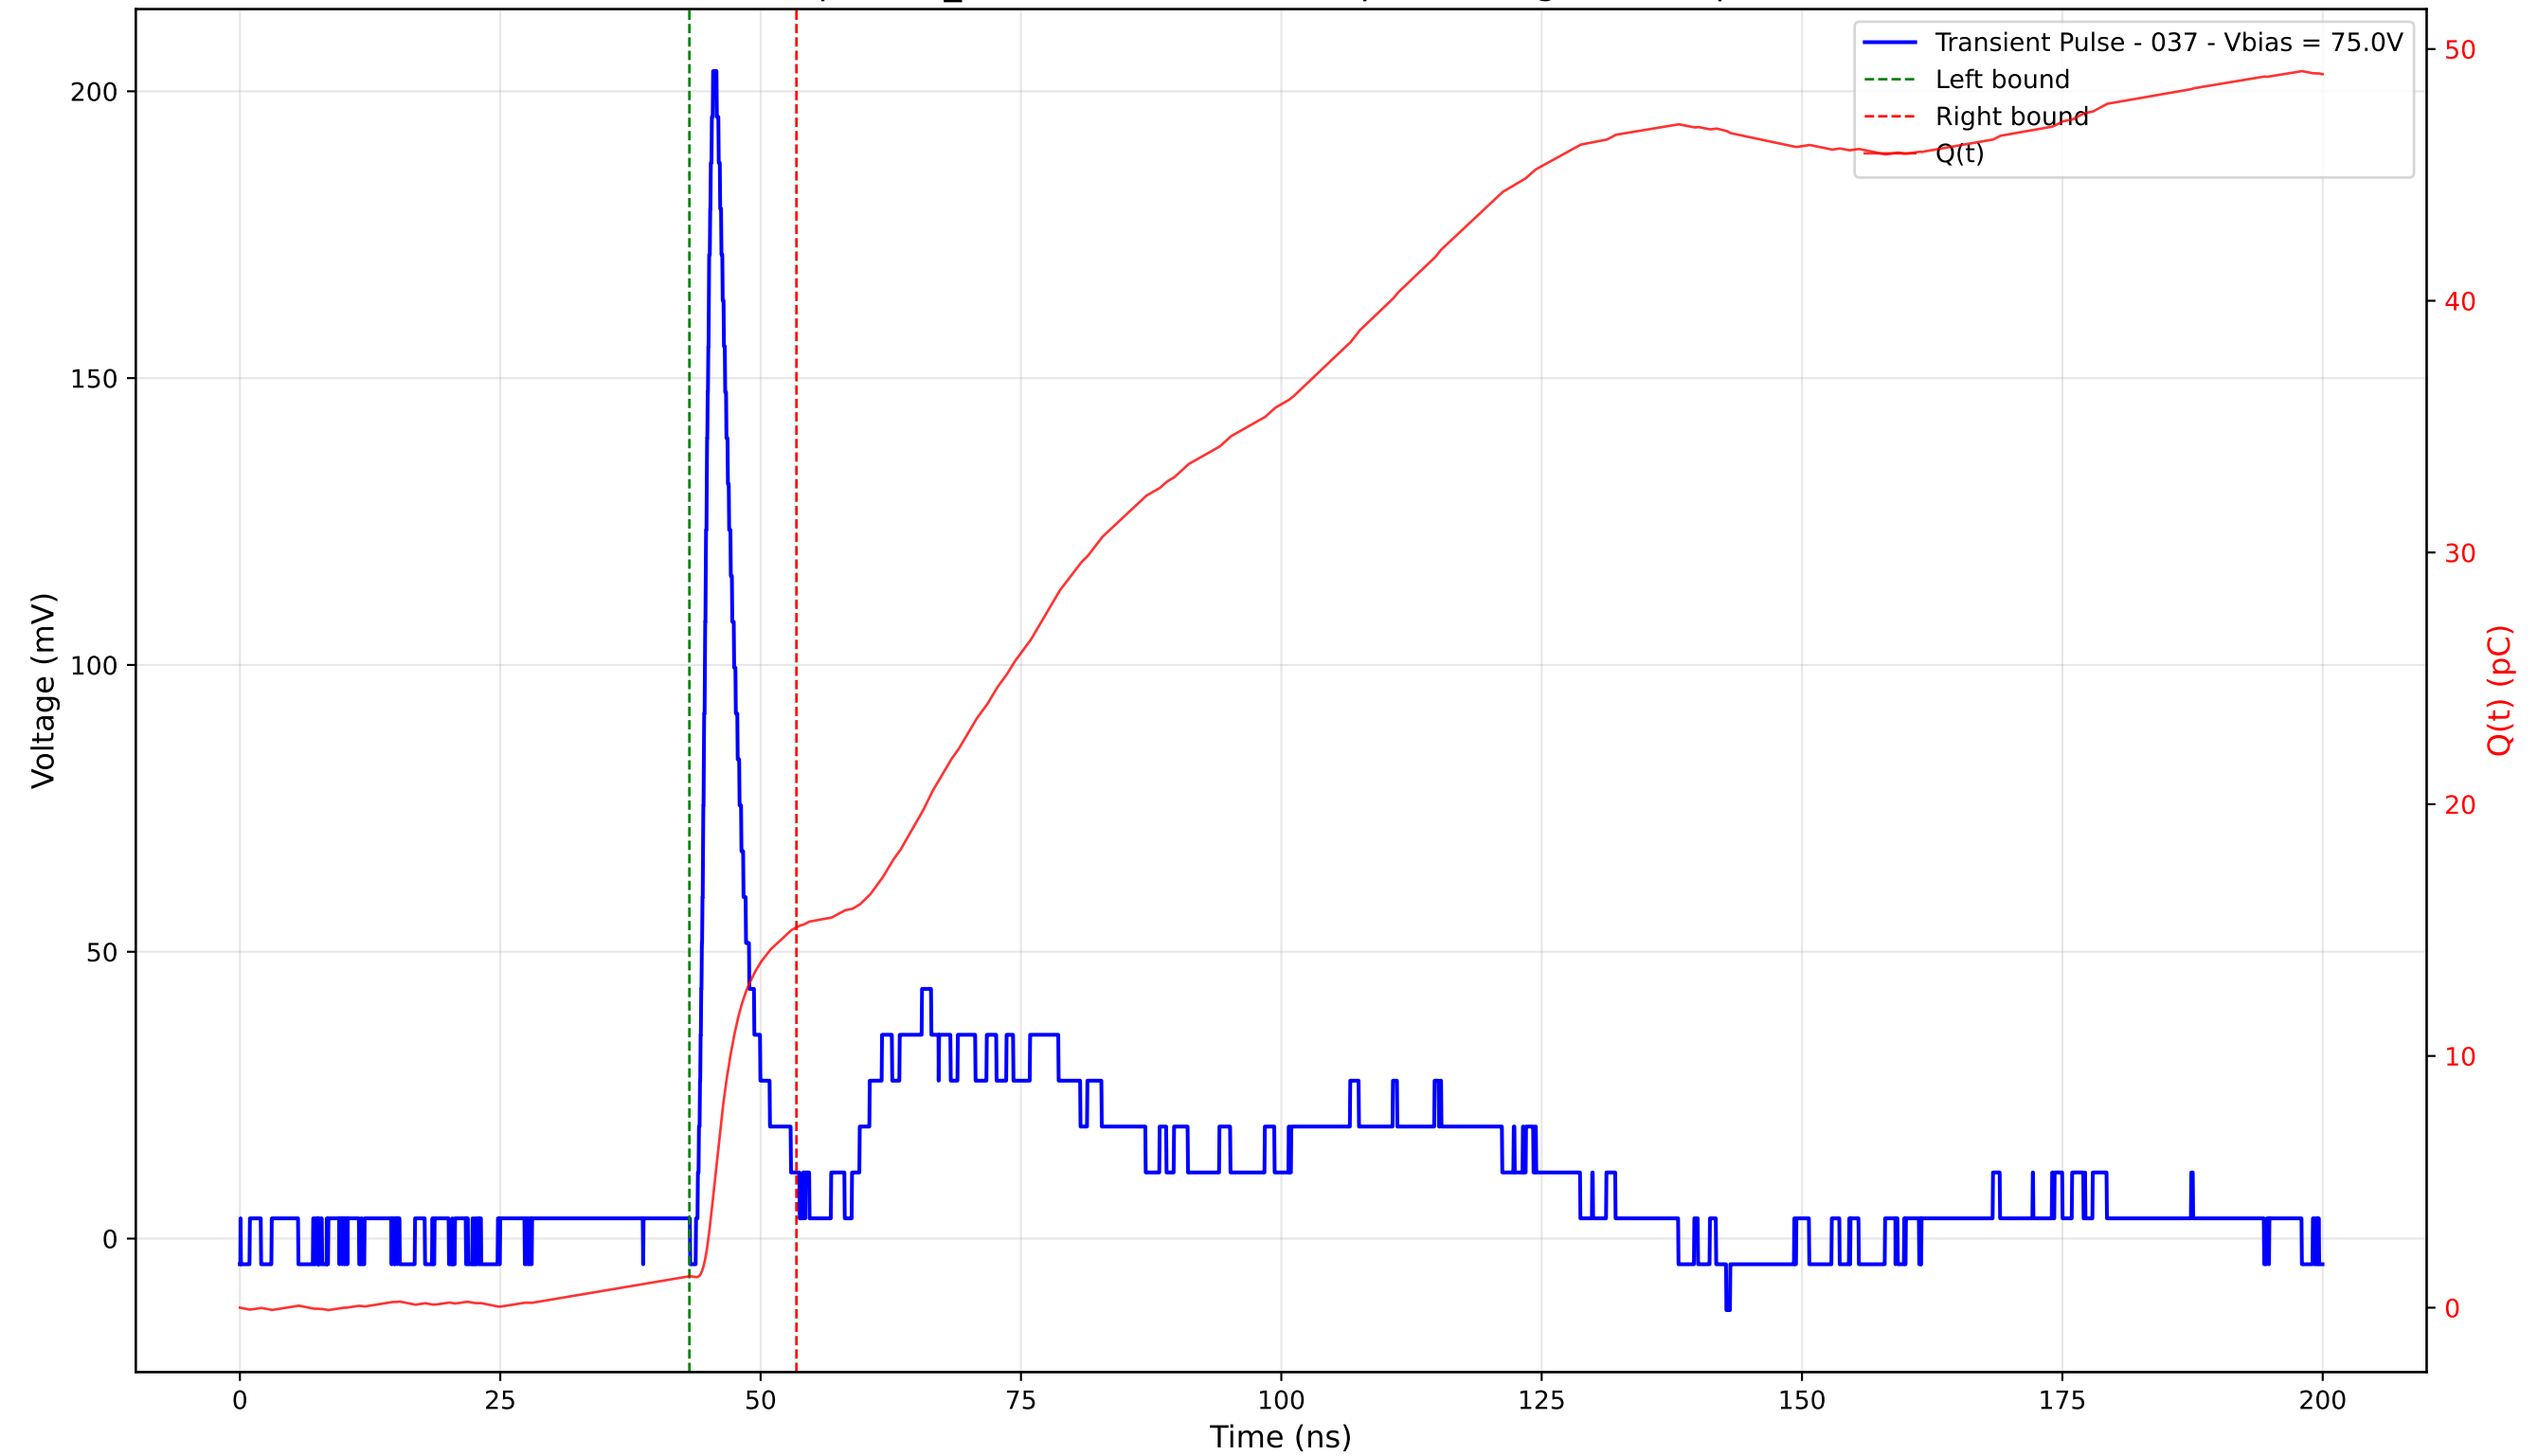


Transient Pulse - Sample: TD_4004 - Position: 350.0 μm - Charge: 14.10 pC - Rise Time: 1.10 ns

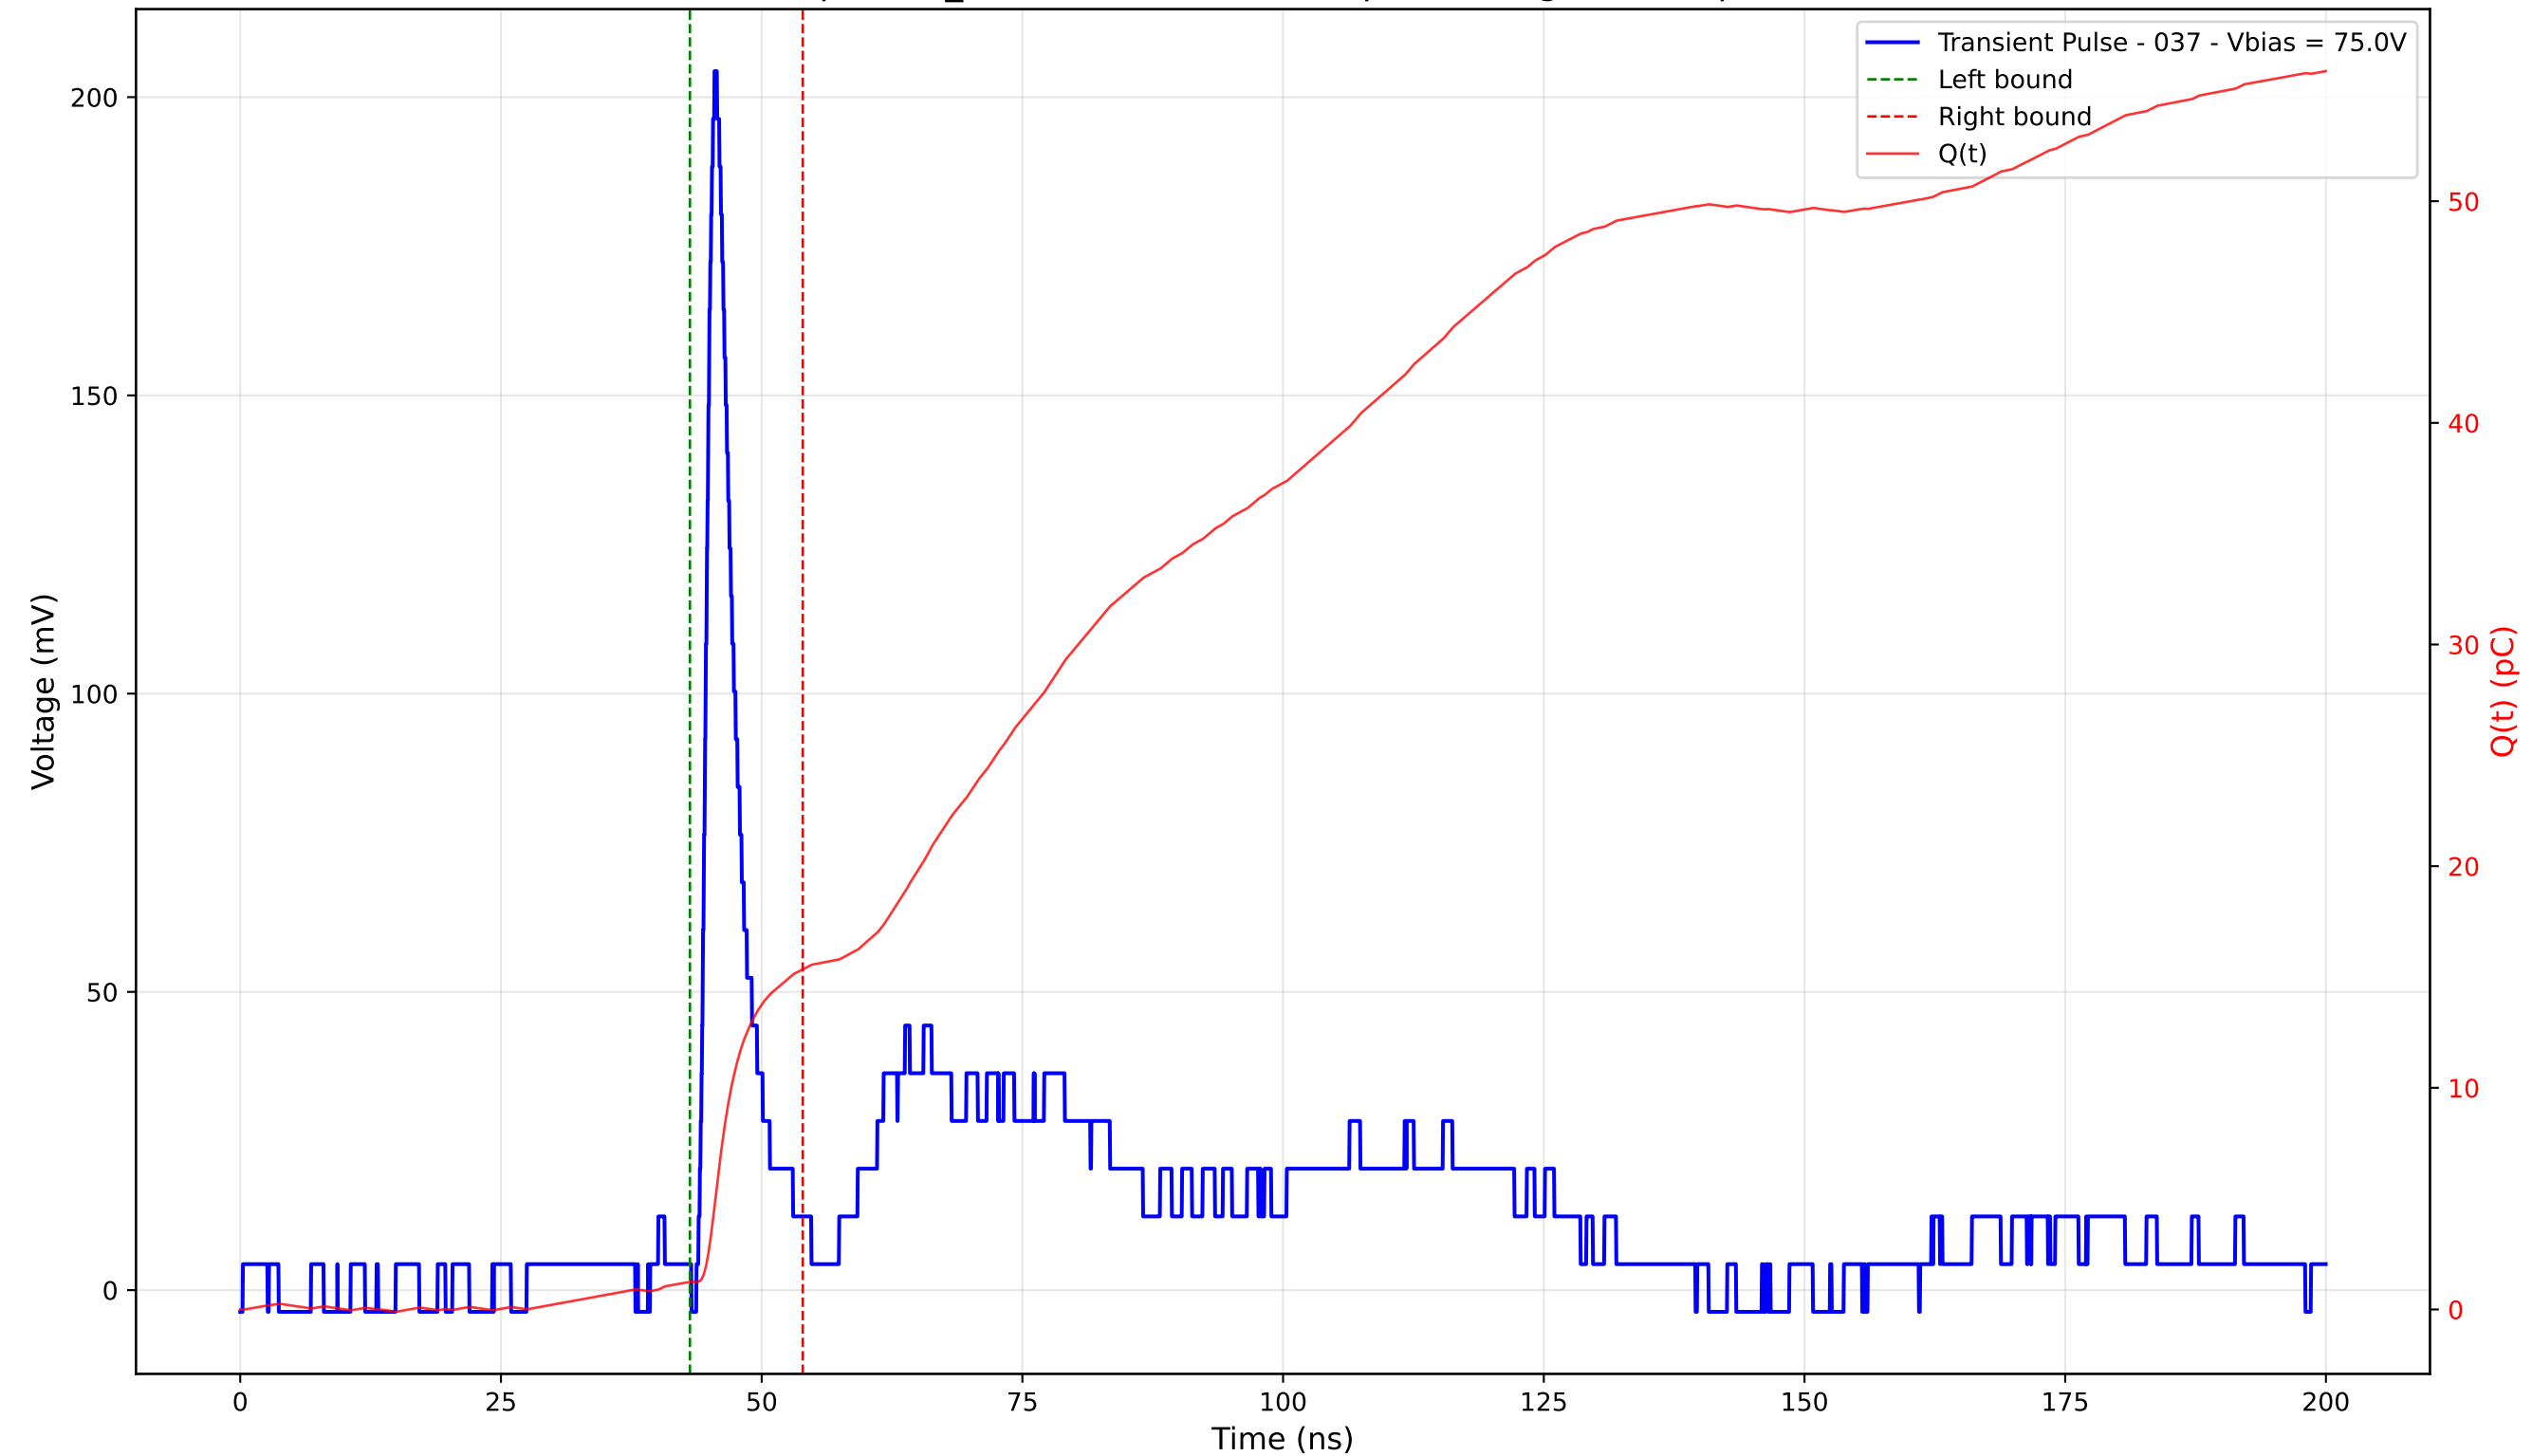


Transient Pulse - Sample: TD_4004 - Position: 355.0 μm - Charge: 13.89 pC - Rise Time: 1.12 ns

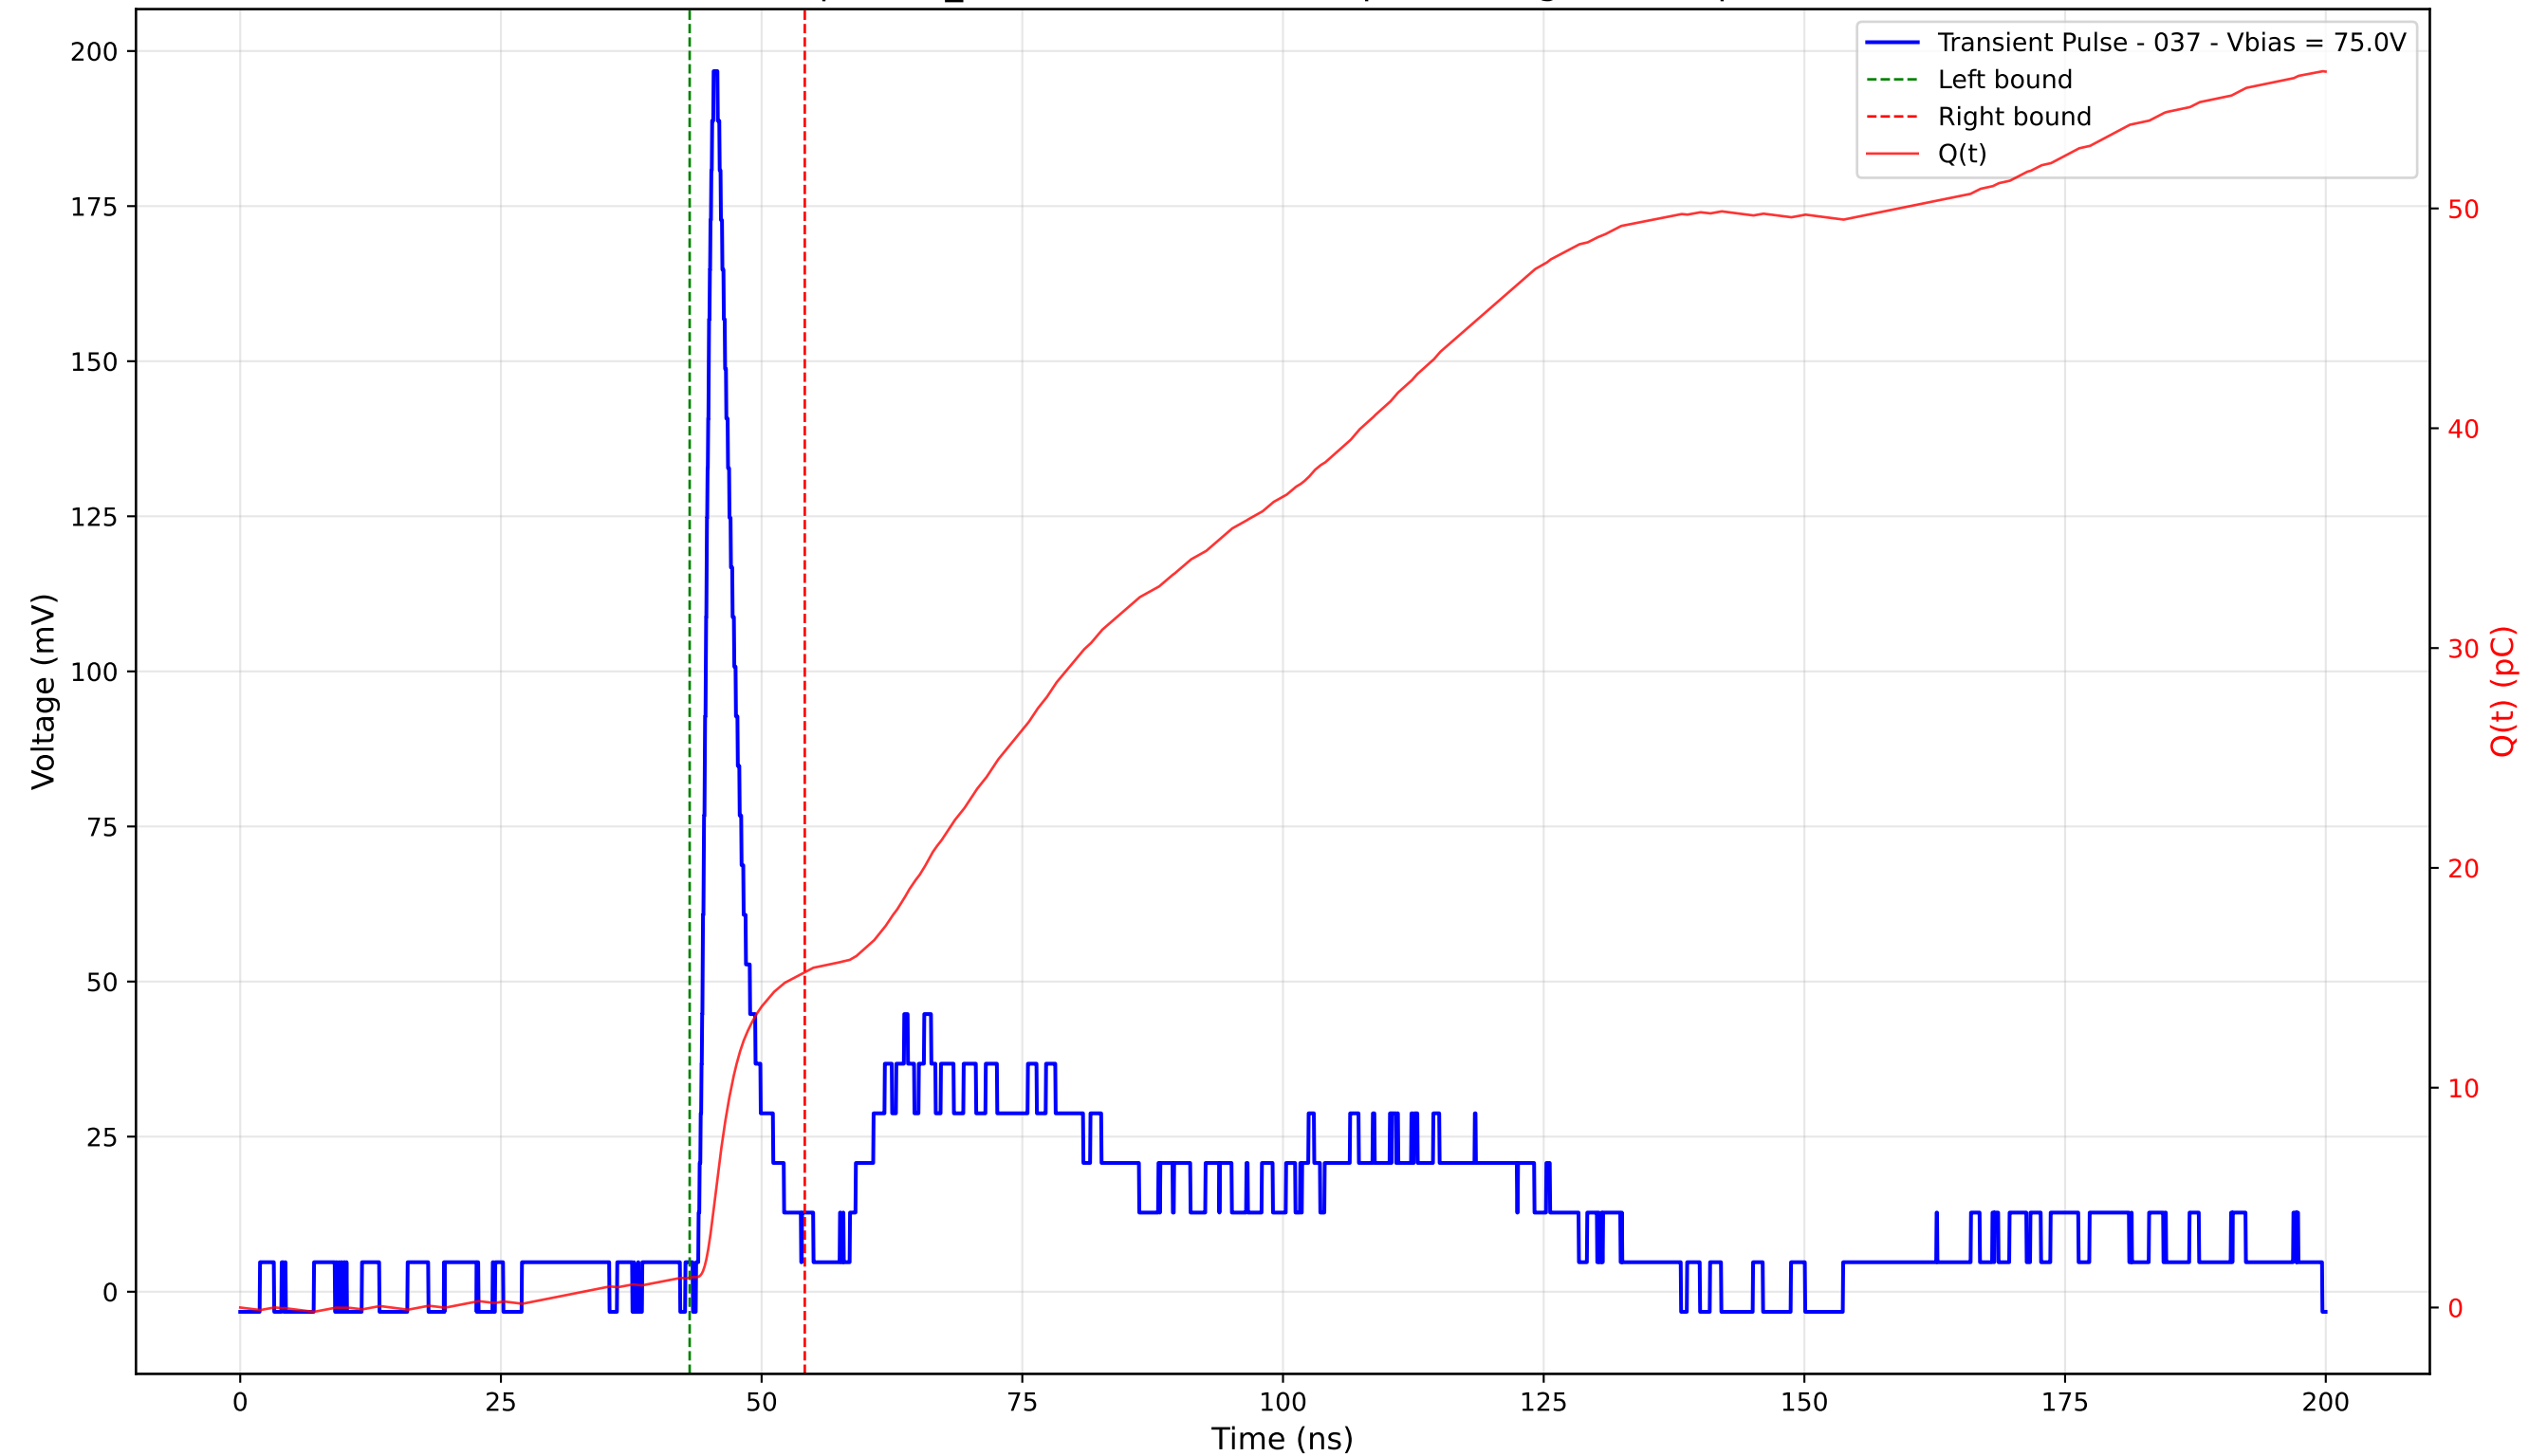


Transient Pulse - Sample: TD_4004 - Position: 360.0 μm - Charge: 12.72 pC - Rise Time: 1.02 ns

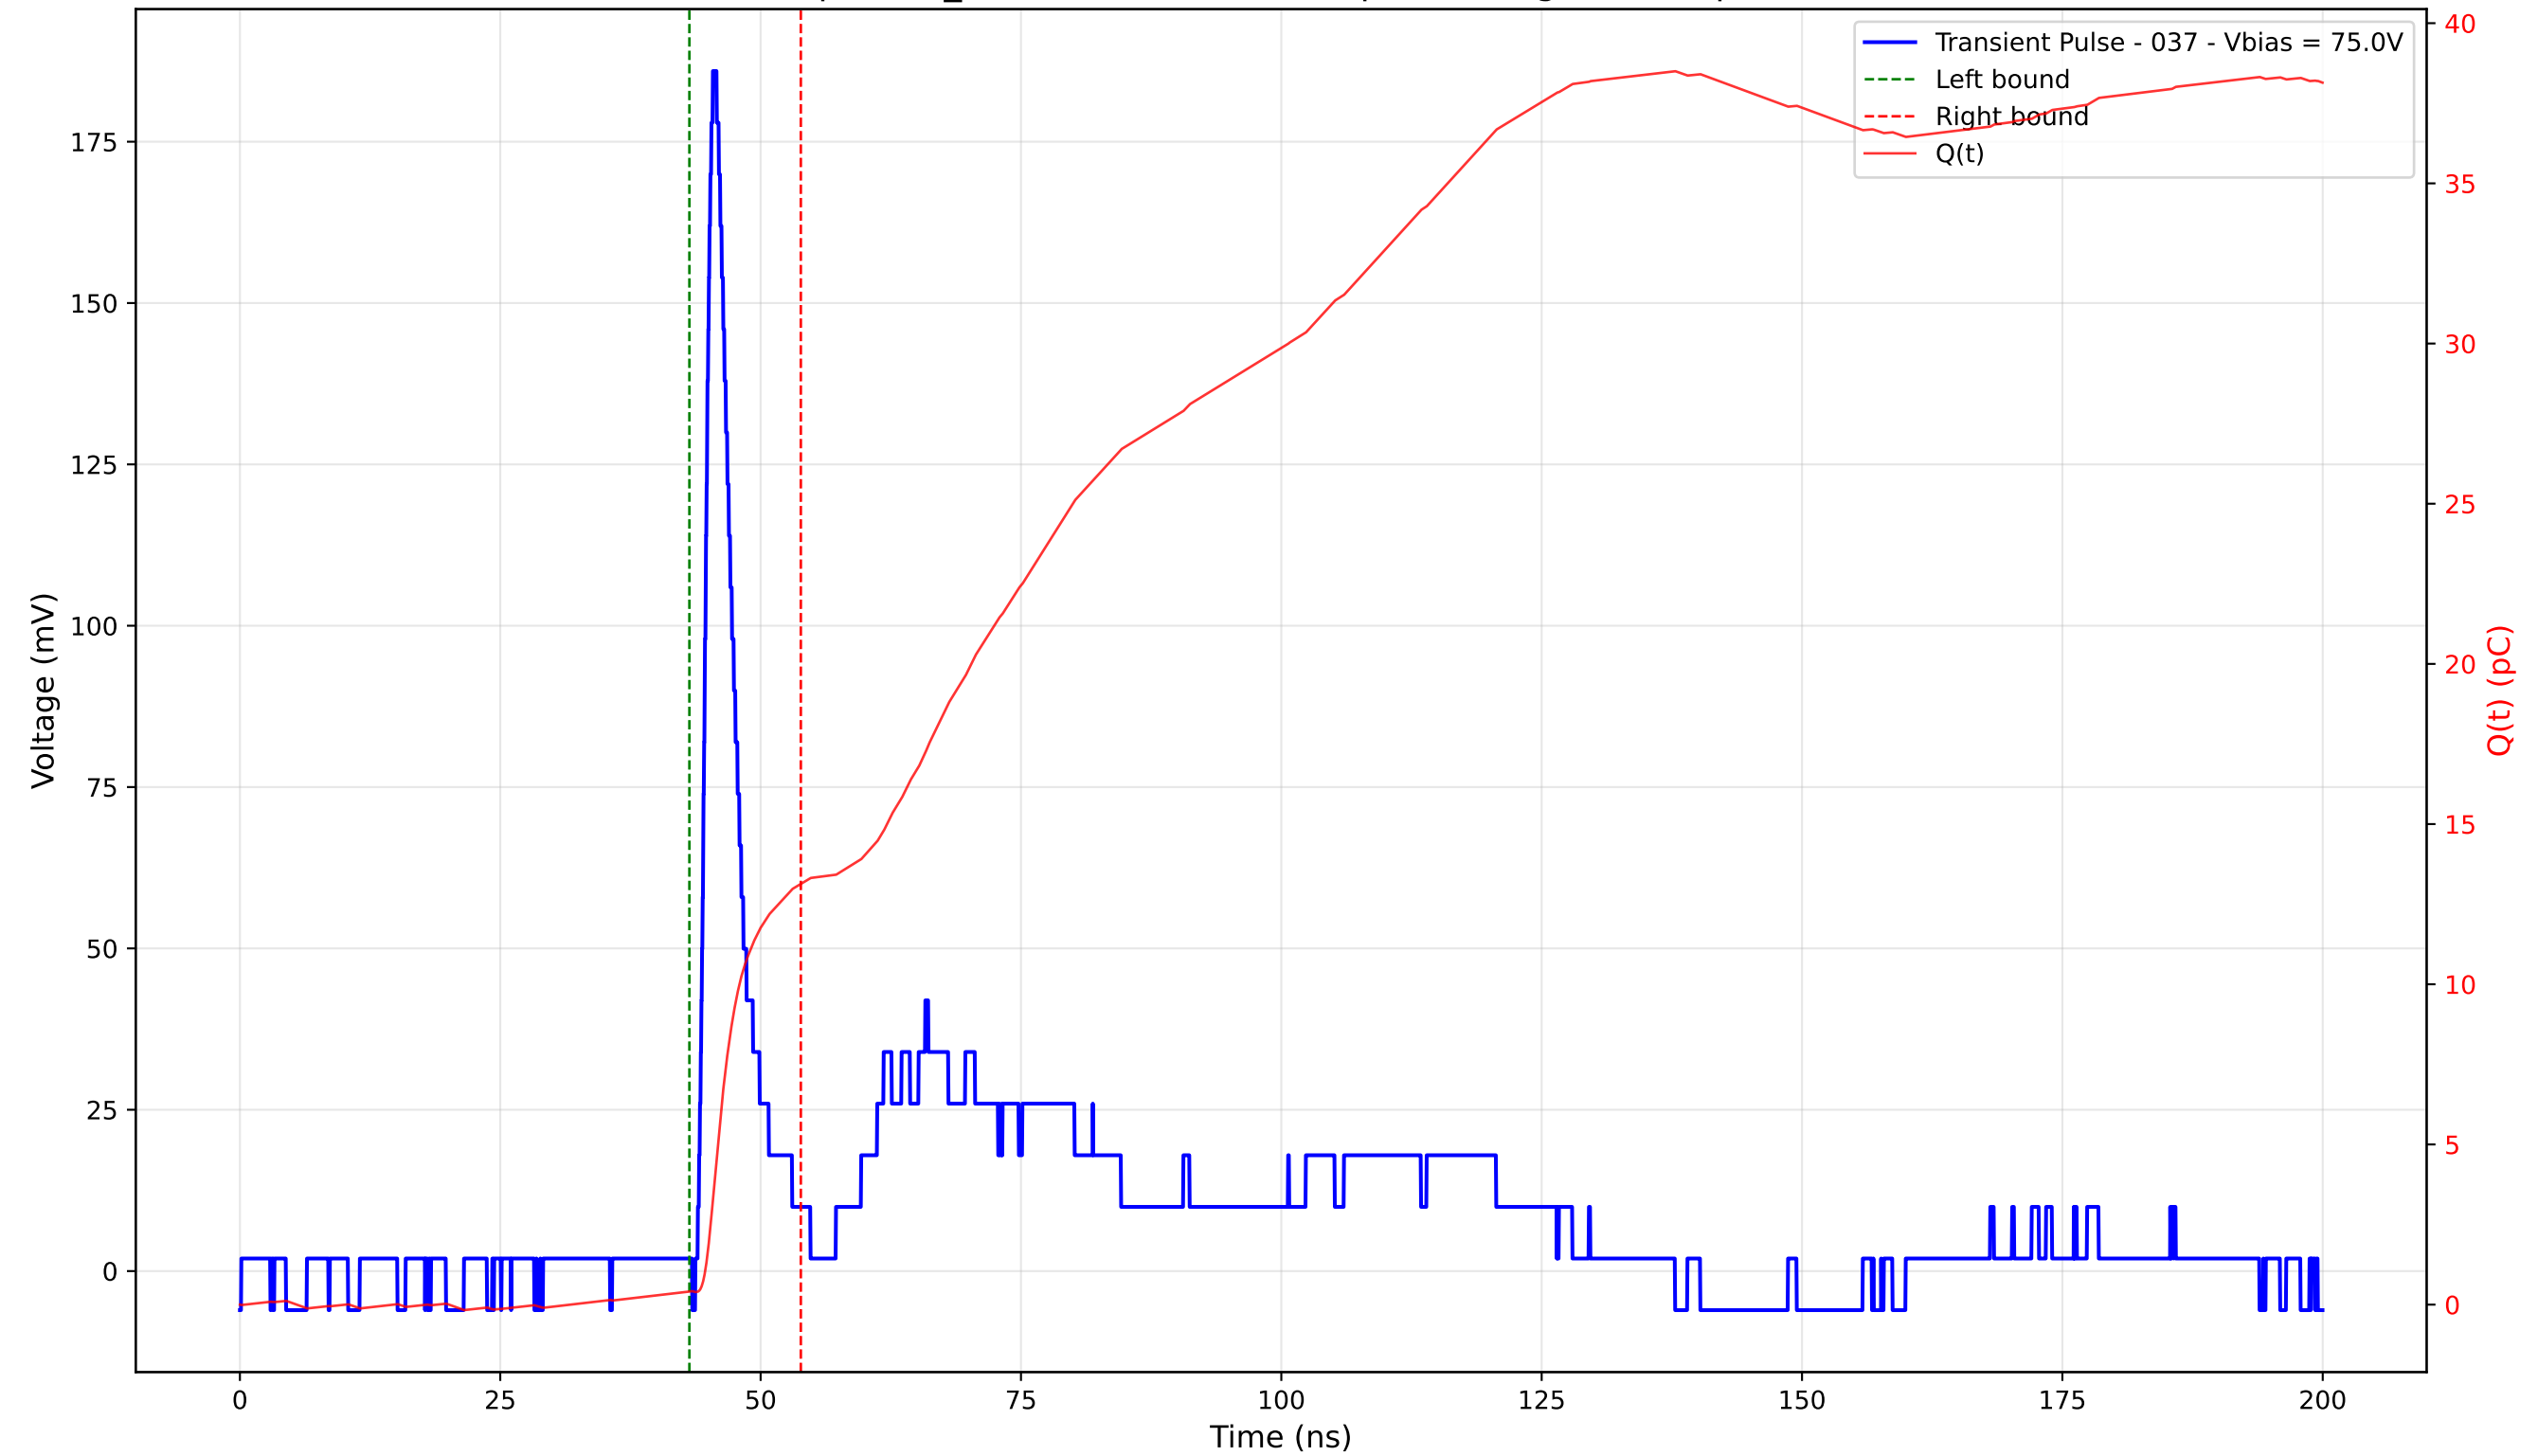


Transient Pulse - Sample: TD_4004 - Position: 365.0 μm - Charge: 11.54 pC - Rise Time: 1.02 ns

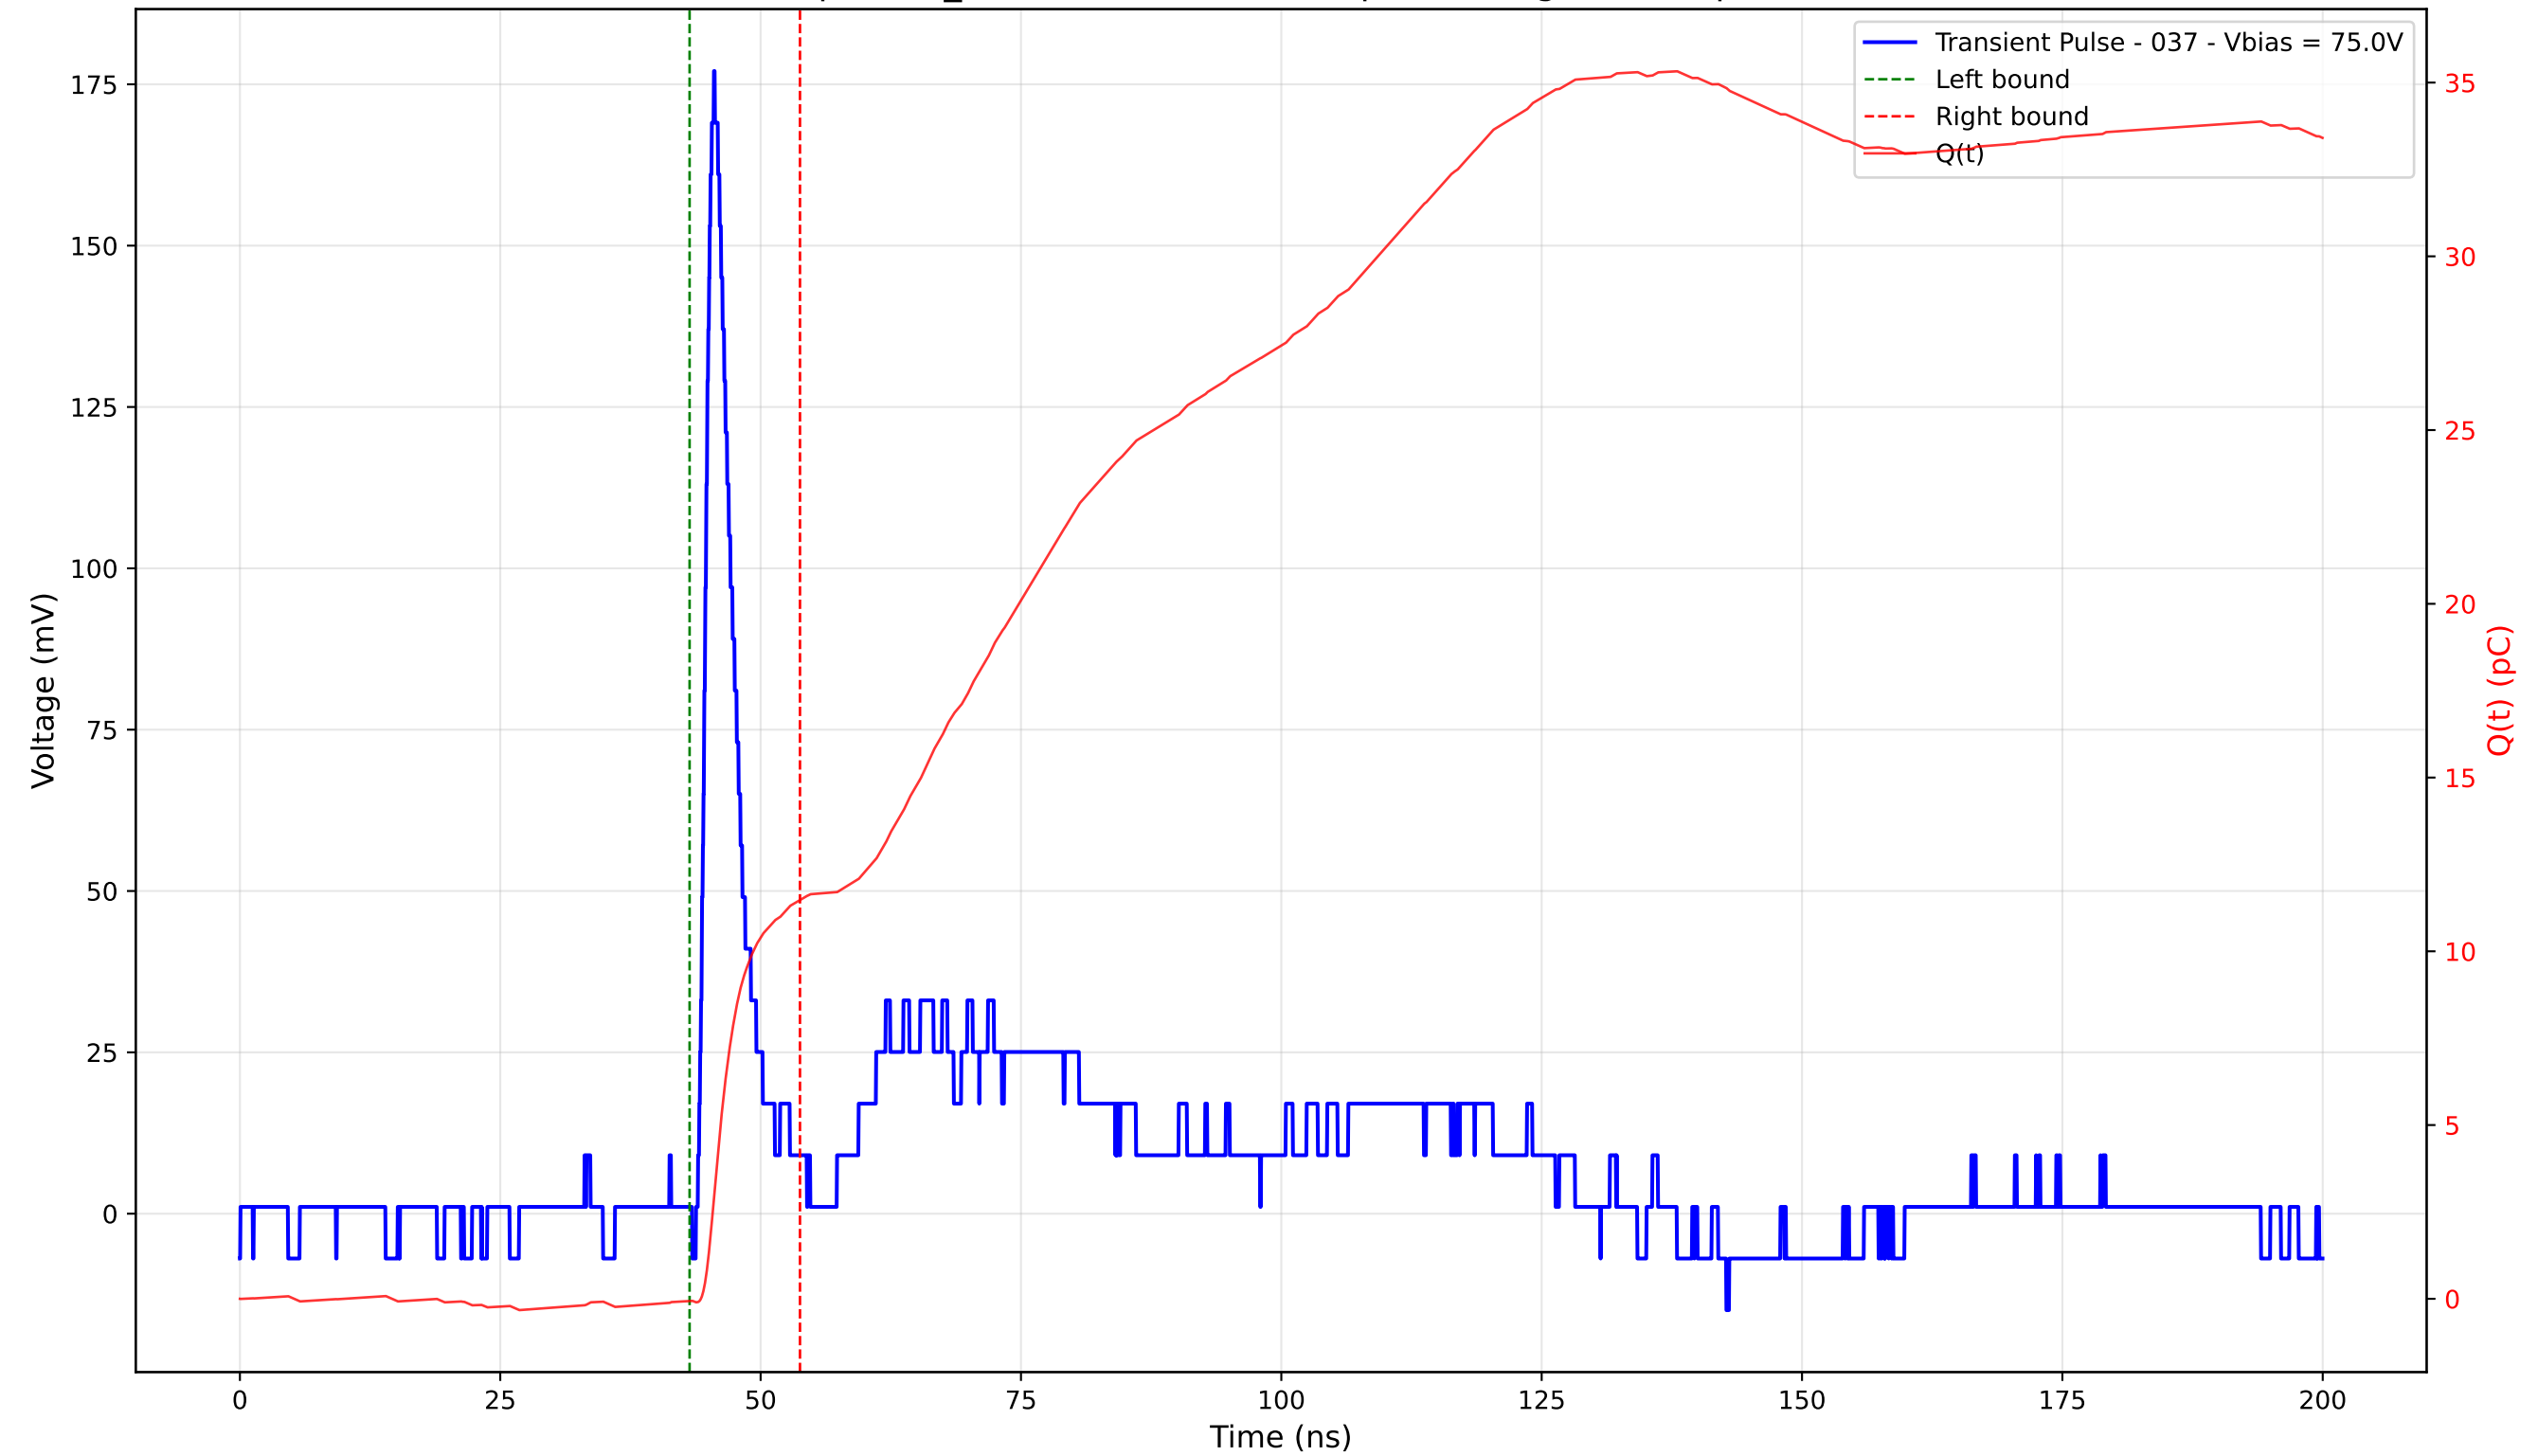


Transient Pulse - Sample: TD_4004 - Position: 370.0 μm - Charge: 11.63 pC - Rise Time: 1.01 ns

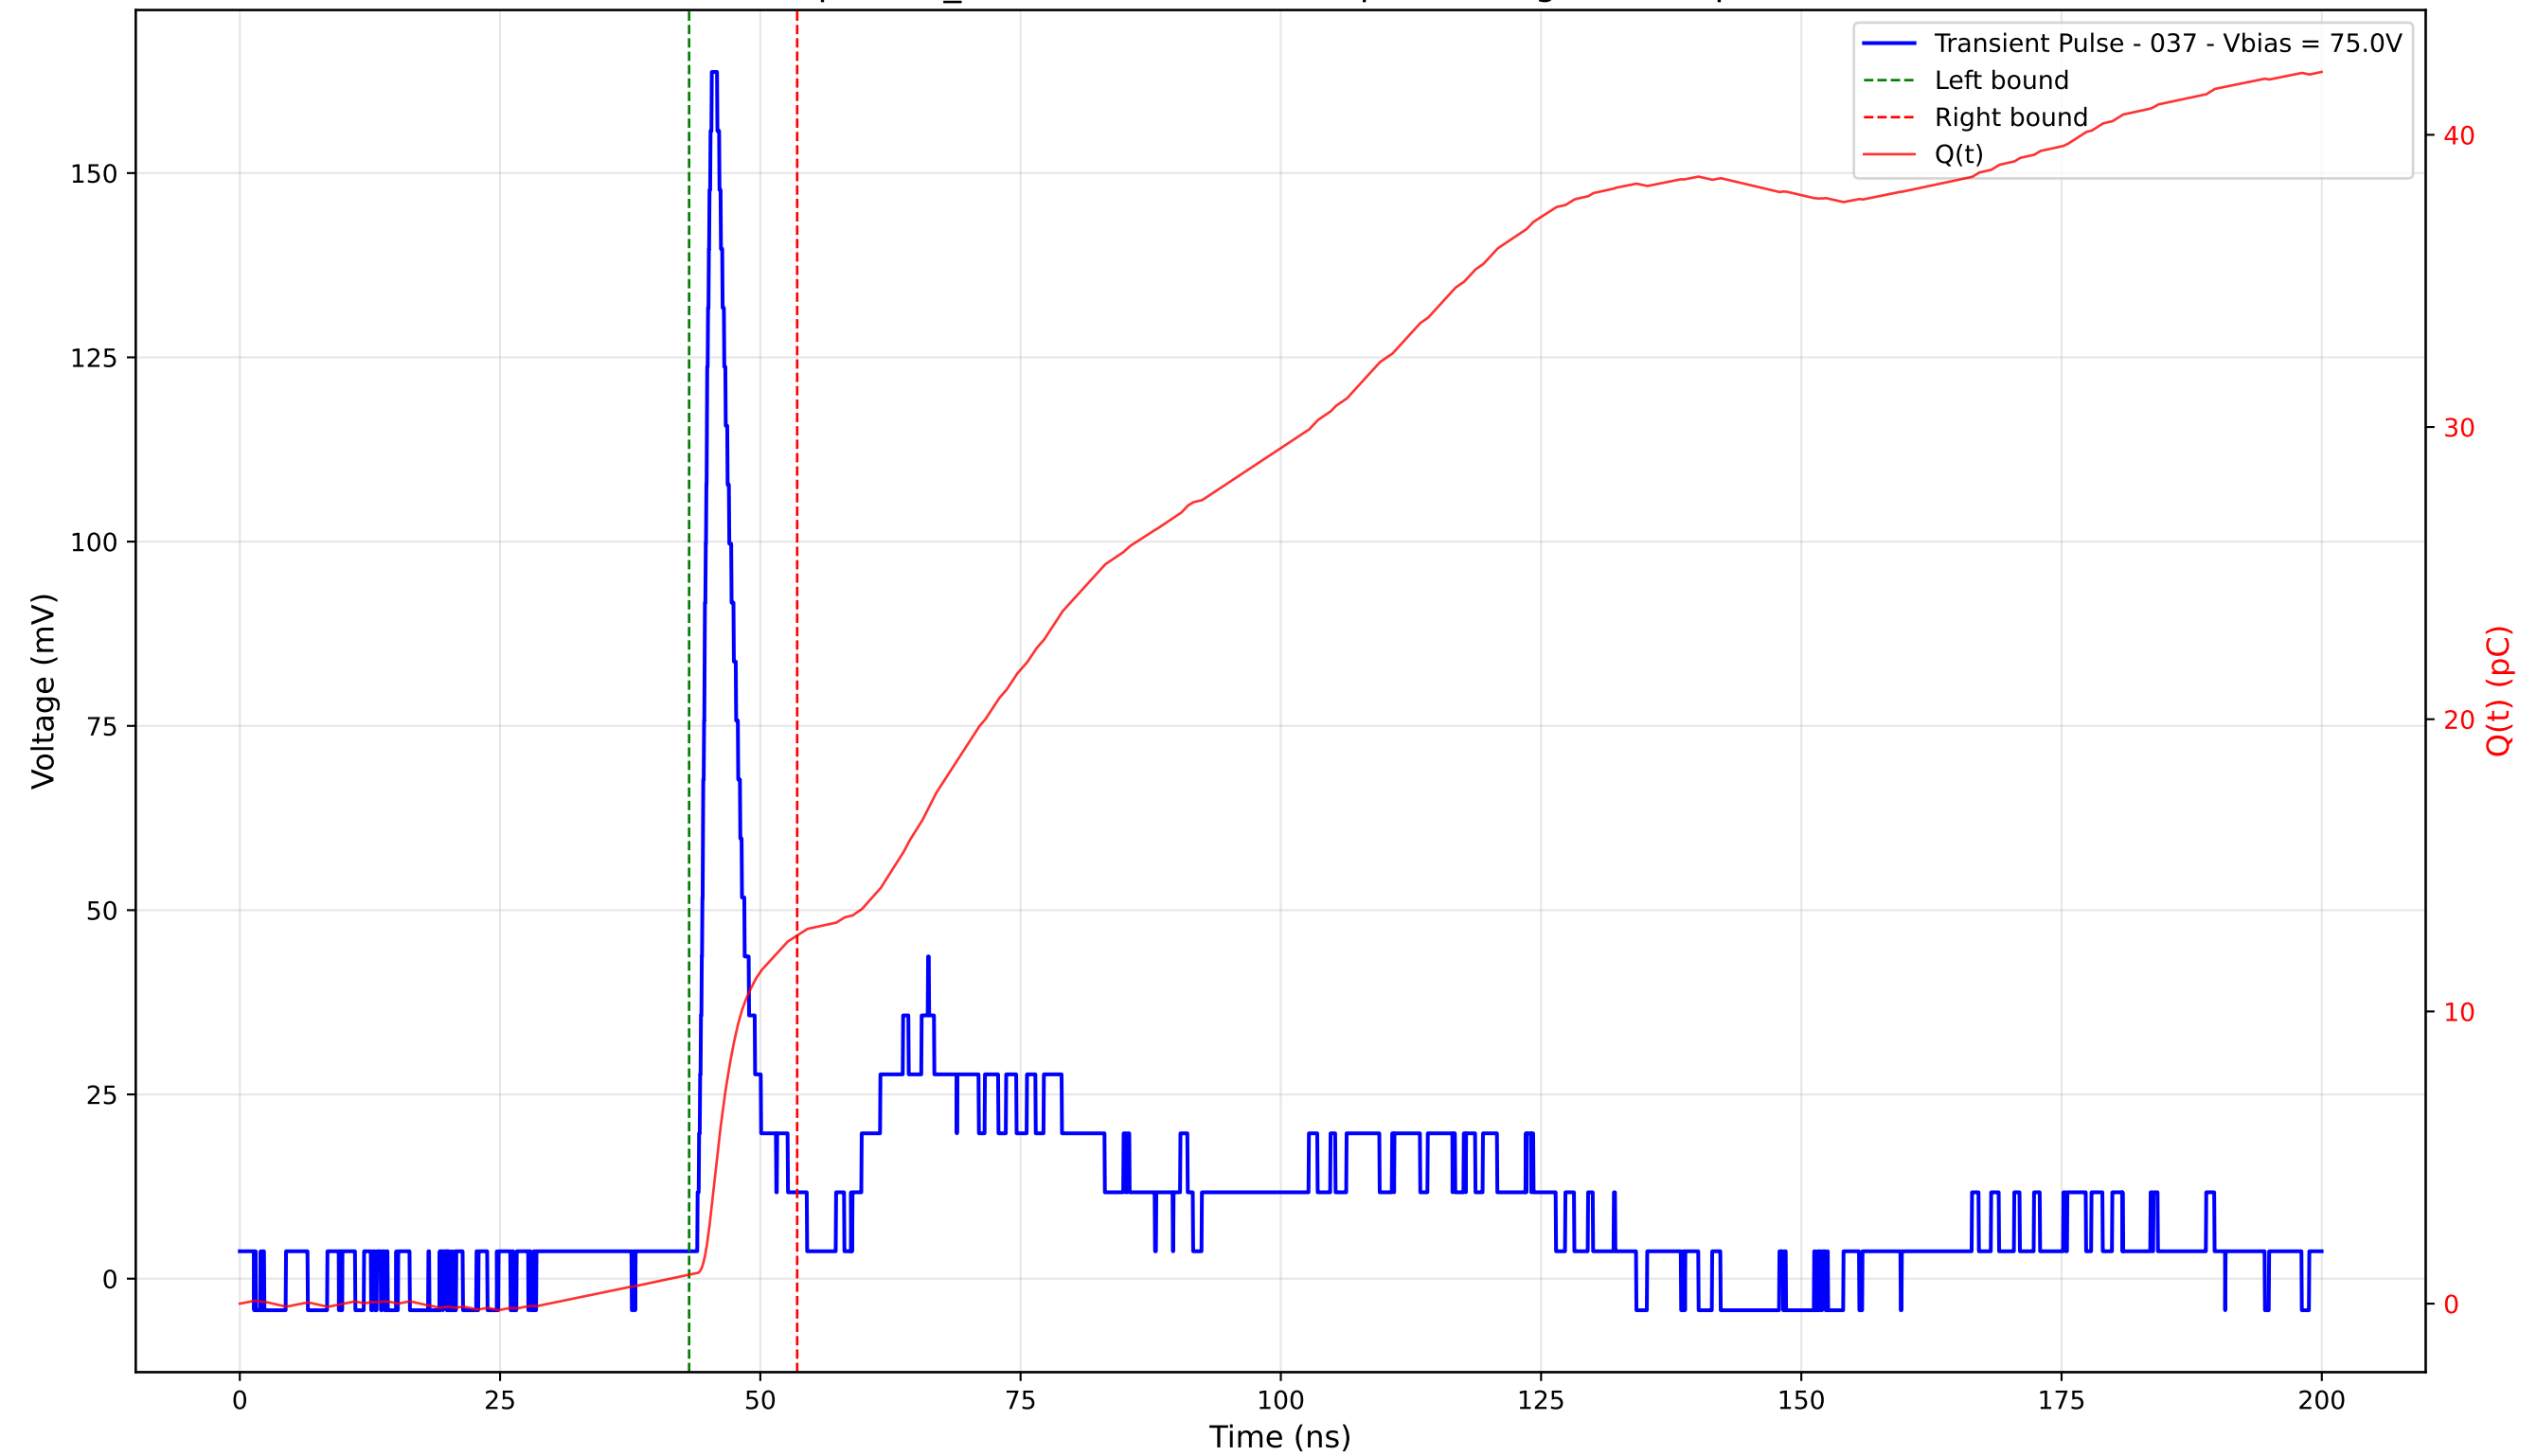


Transient Pulse - Sample: TD_4004 - Position: 375.0 μm - Charge: 11.38 pC - Rise Time: 1.02 ns

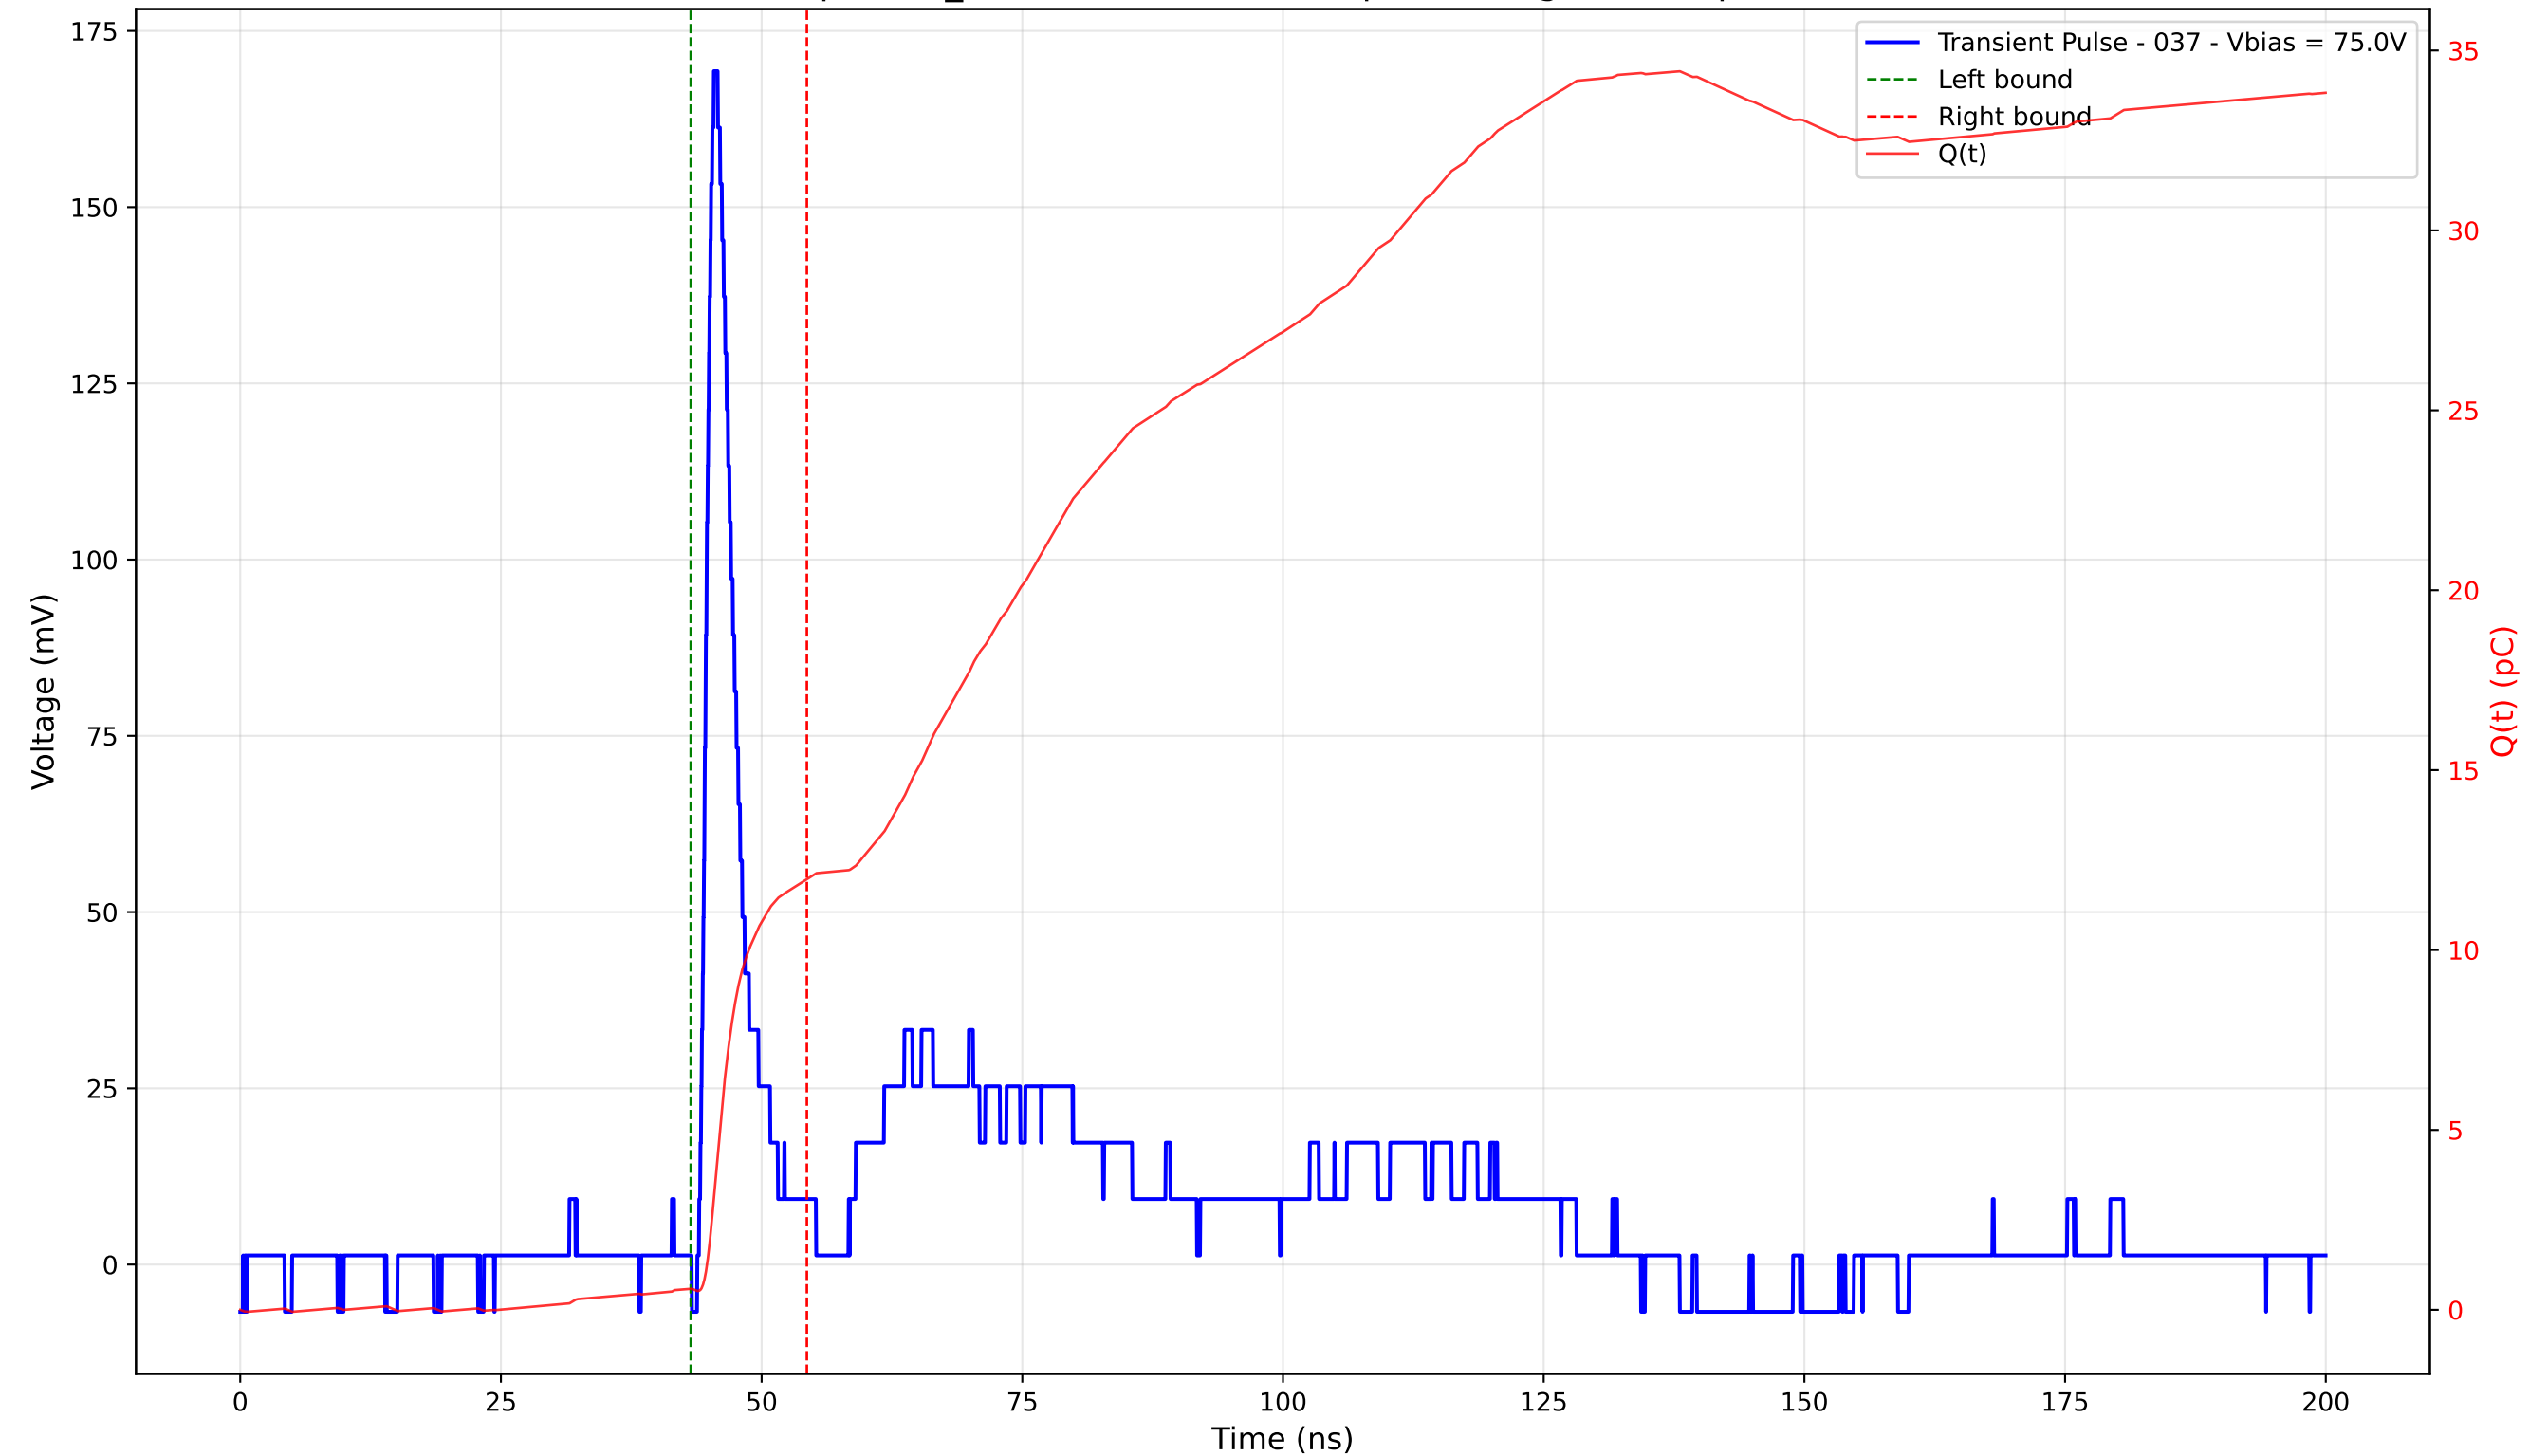


Transient Pulse - Sample: TD_4004 - Position: 380.0 μm - Charge: 11.80 pC - Rise Time: 0.98 ns

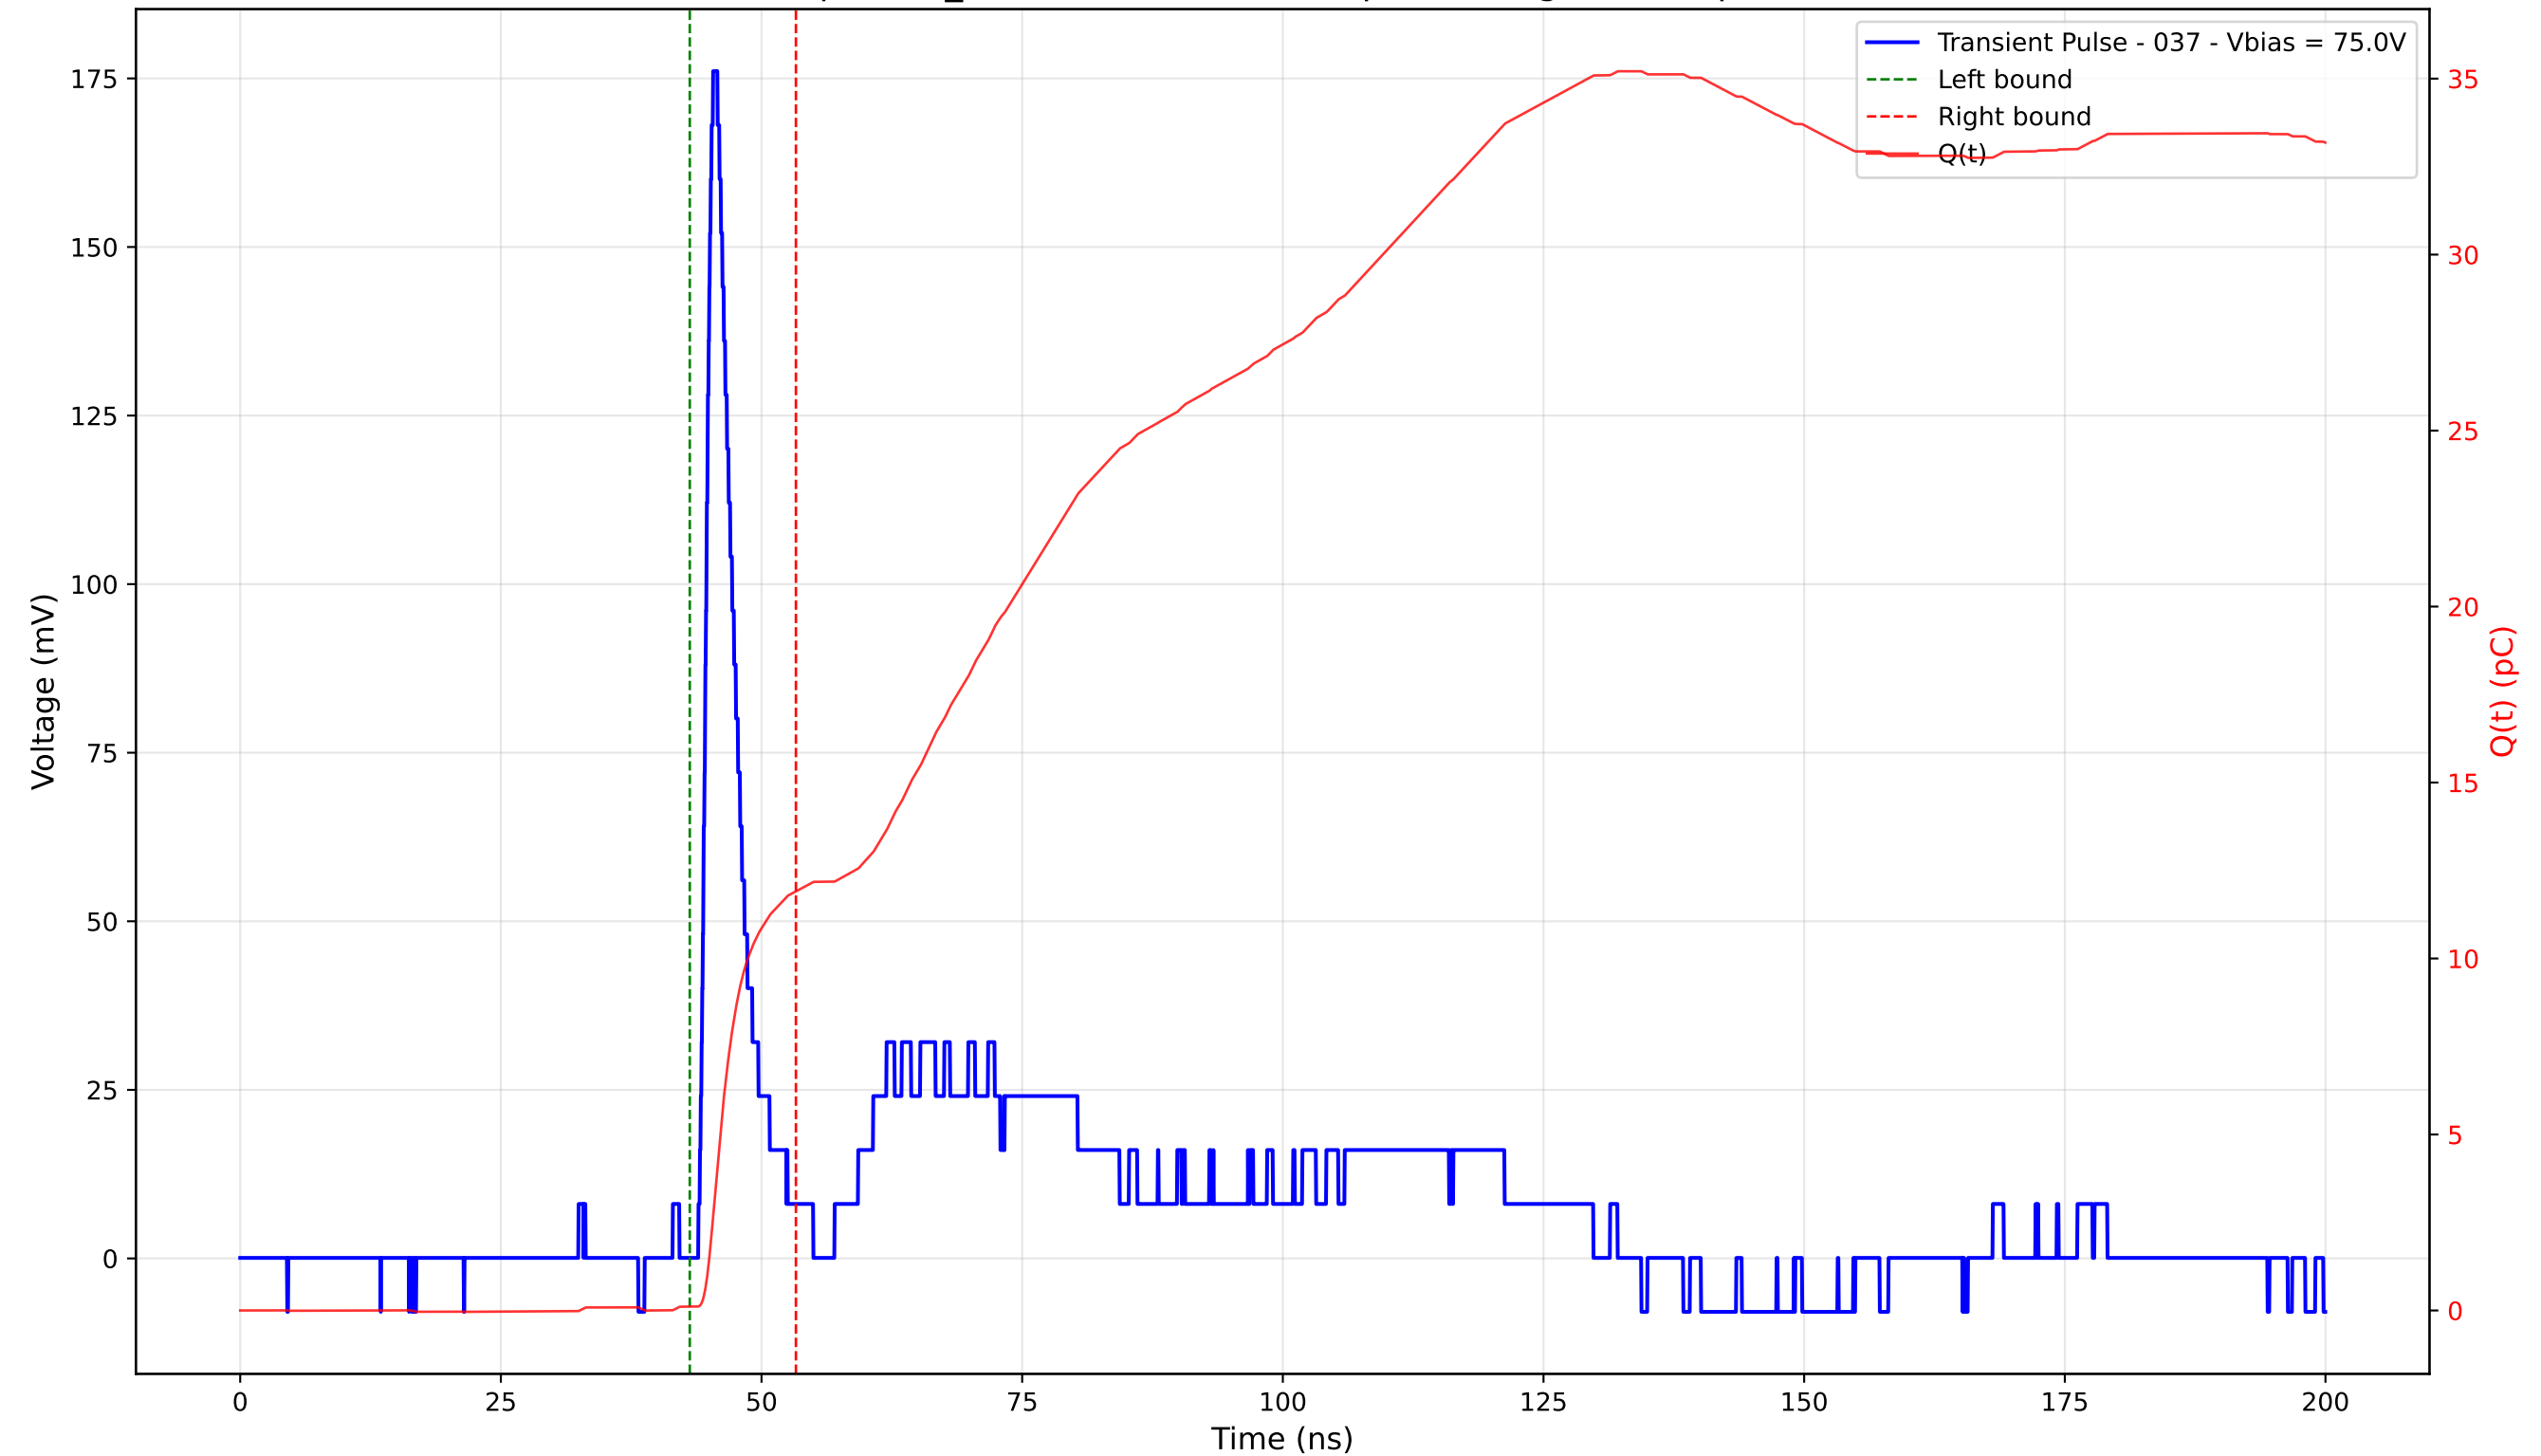


Transient Pulse - Sample: TD_4004 - Position: 385.0 μm - Charge: 11.36 pC - Rise Time: 1.06 ns

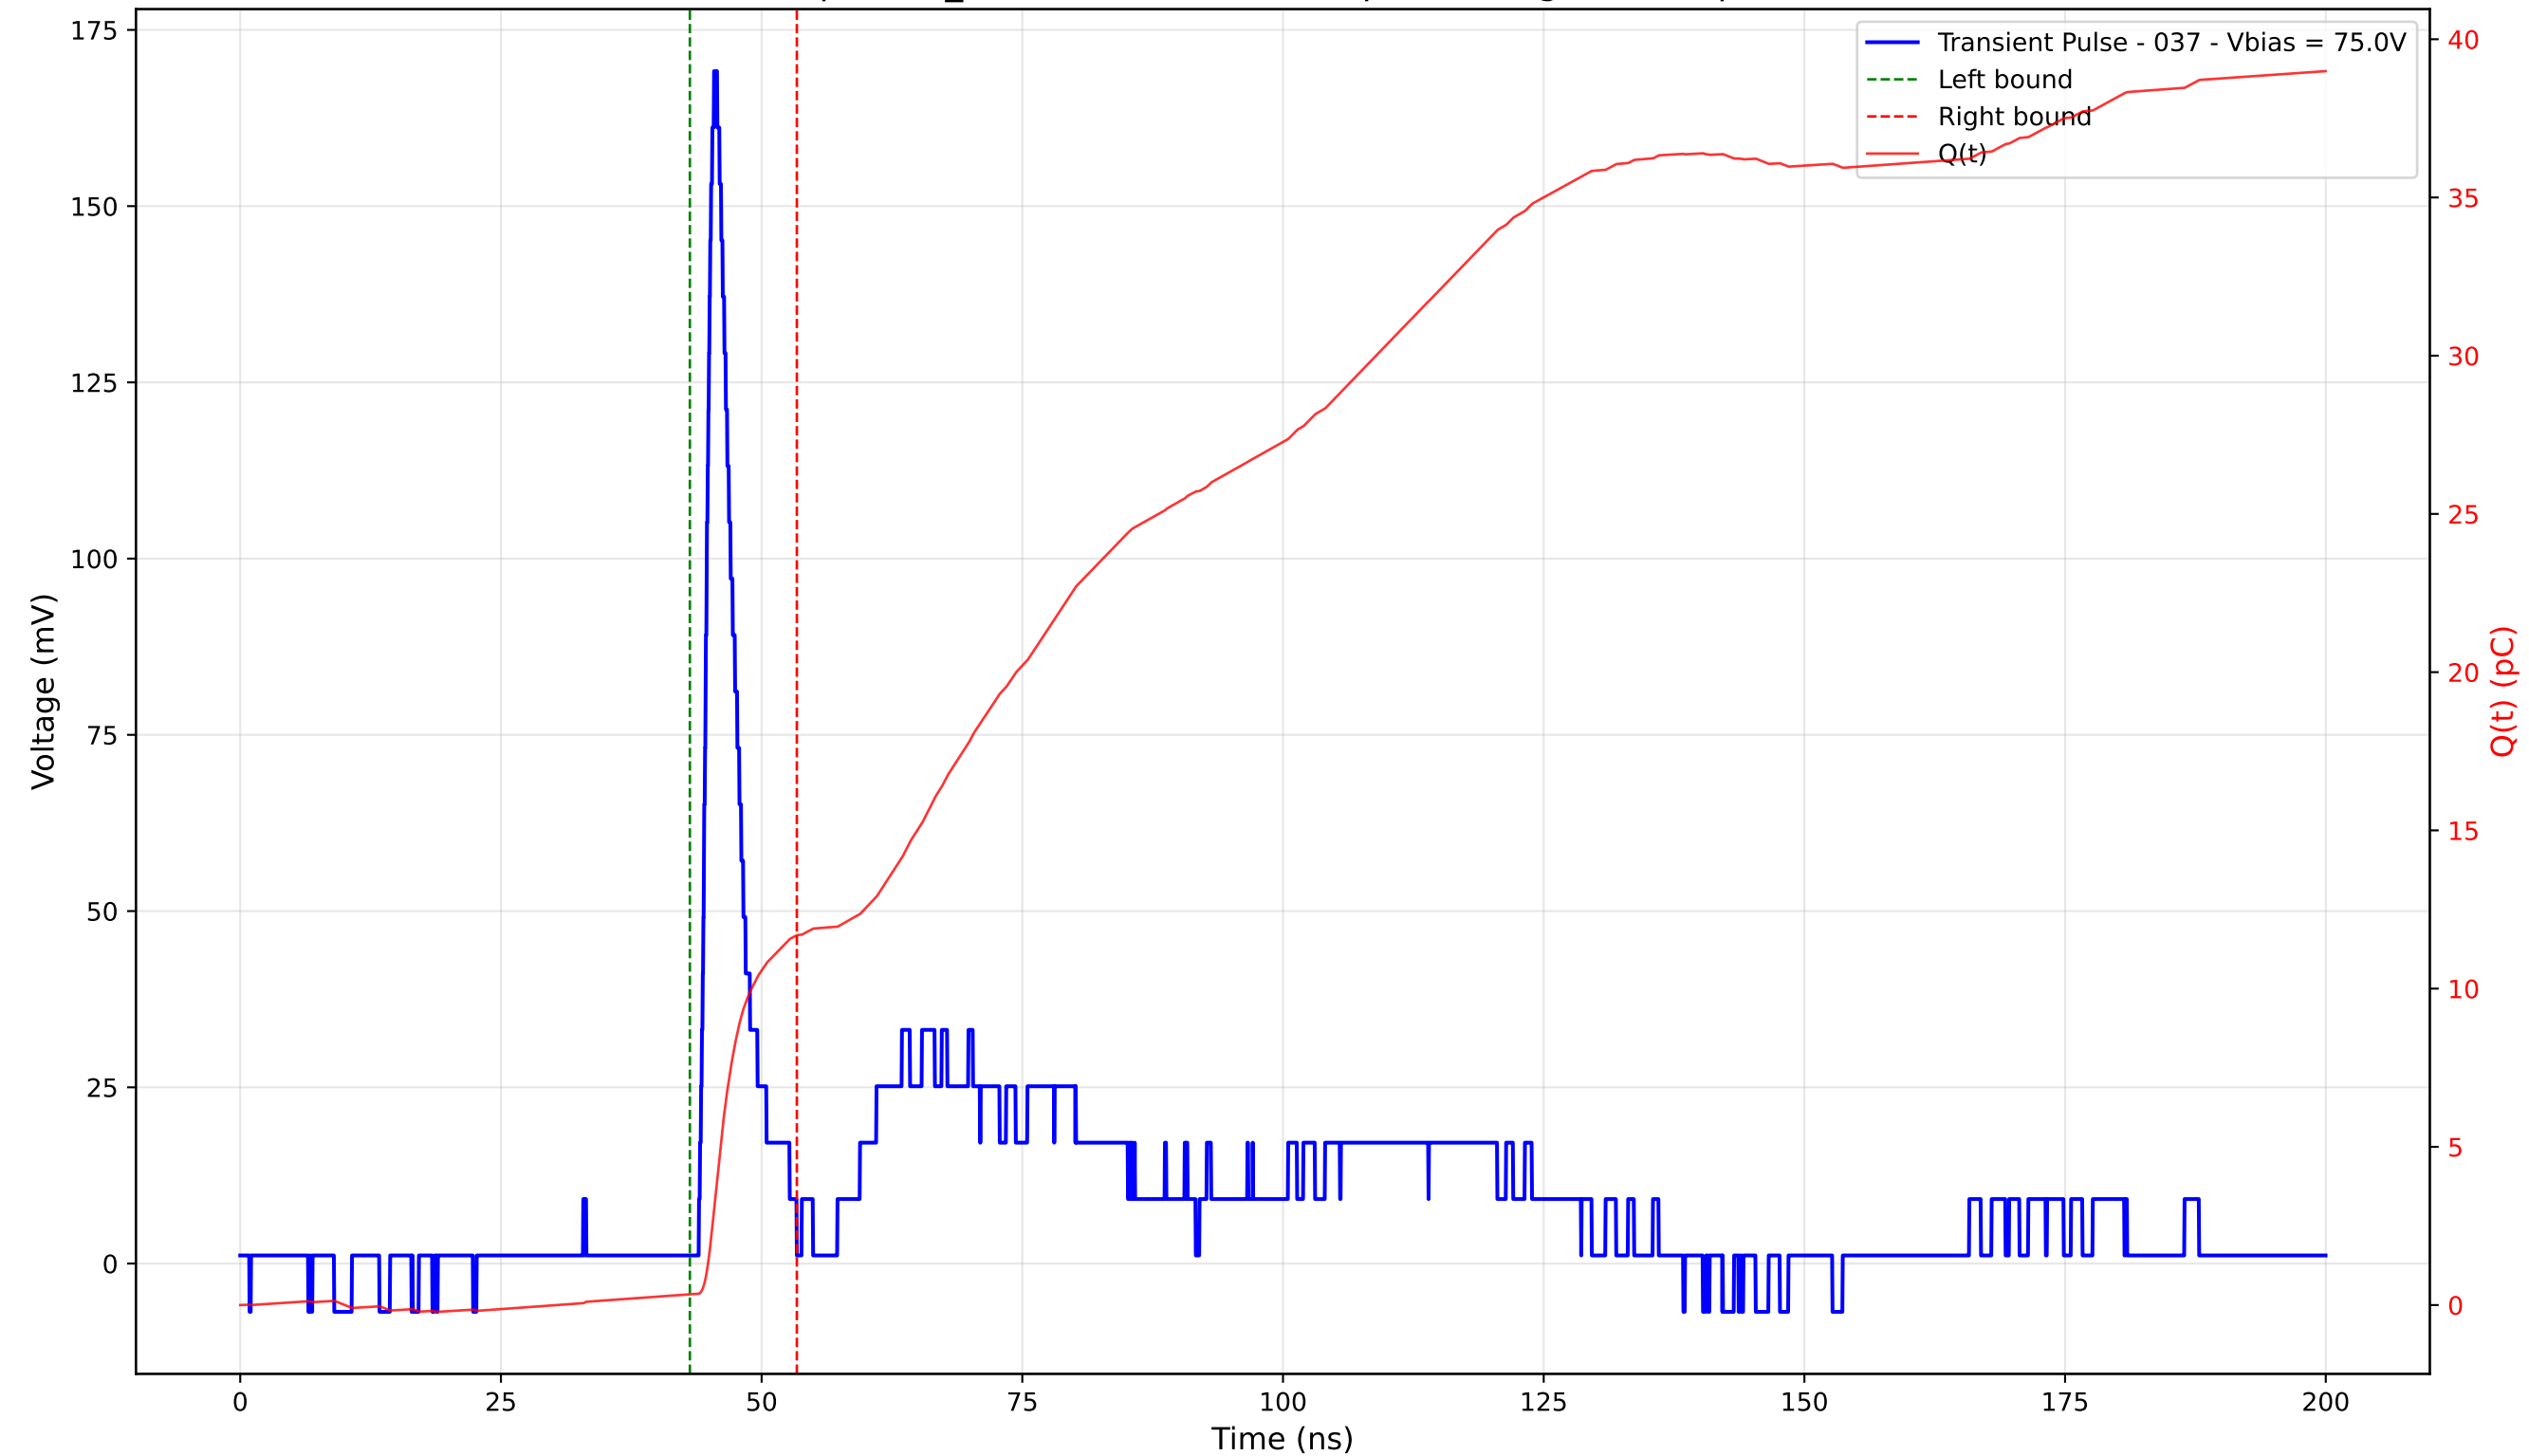


Transient Pulse - Sample: TD_4004 - Position: 390.0 μm - Charge: 8.99 pC - Rise Time: 0.99 ns

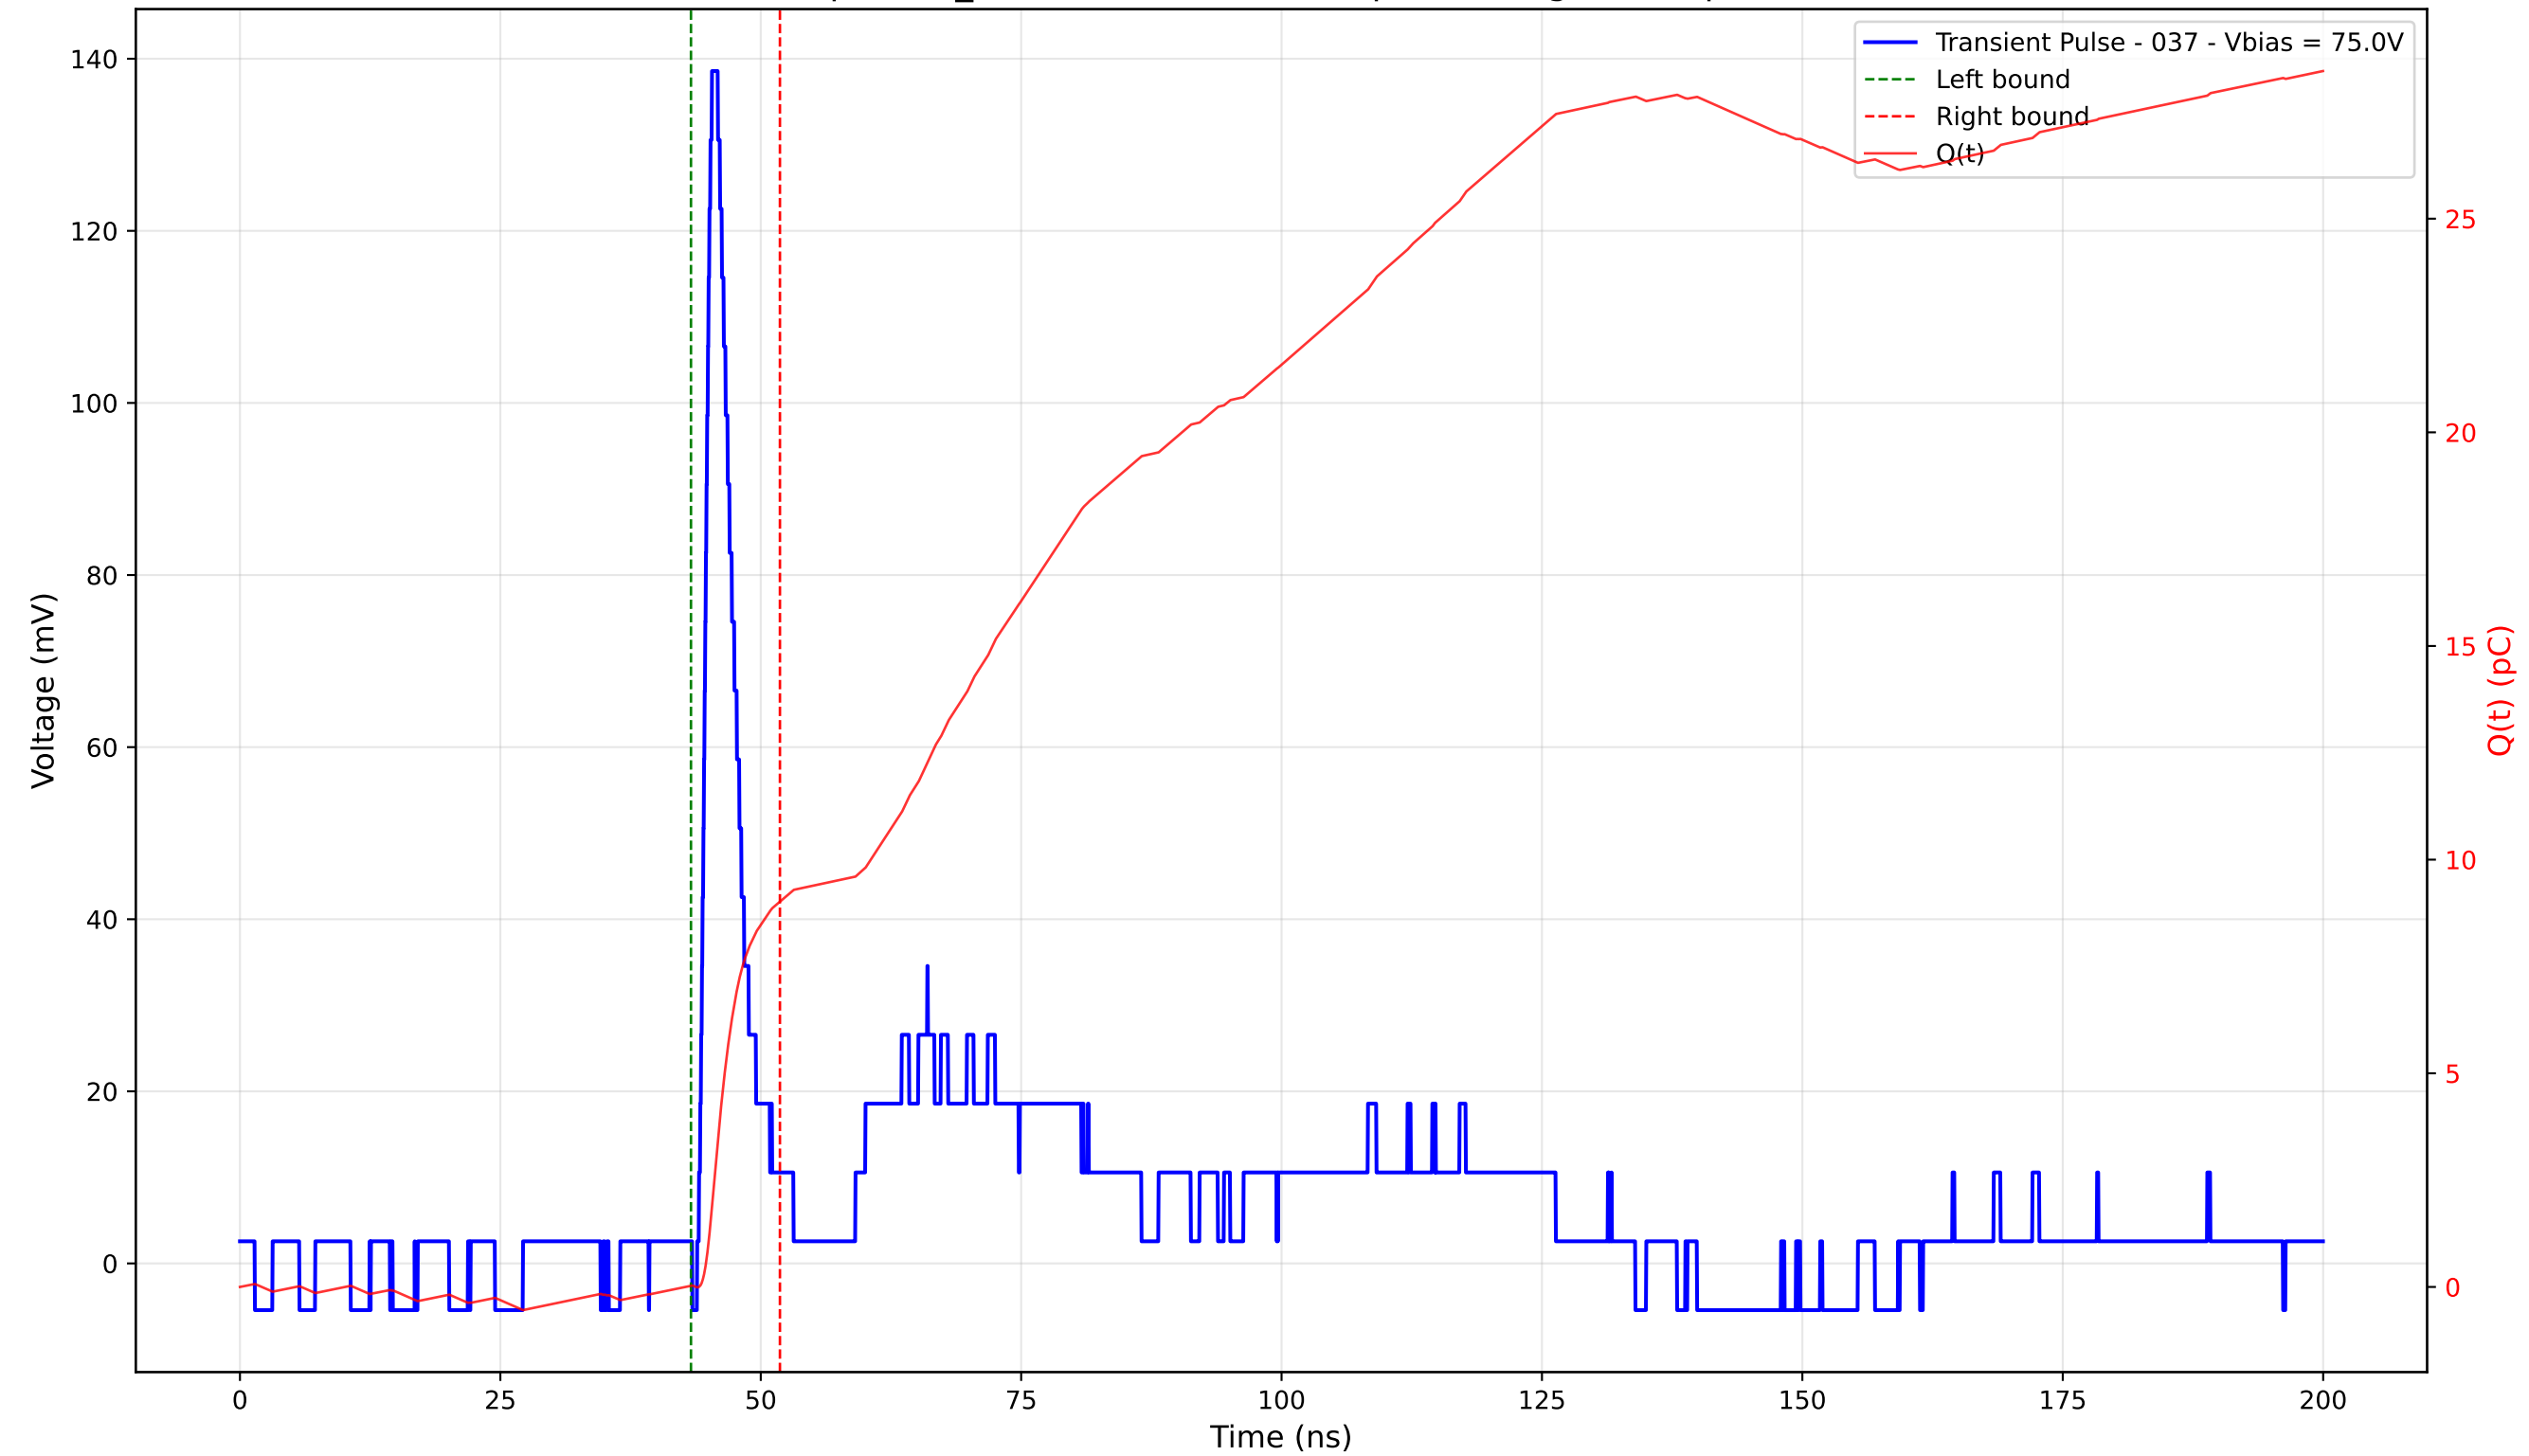


Transient Pulse - Sample: TD_4004 - Position: 395.0 μm - Charge: 8.08 pC - Rise Time: 0.99 ns

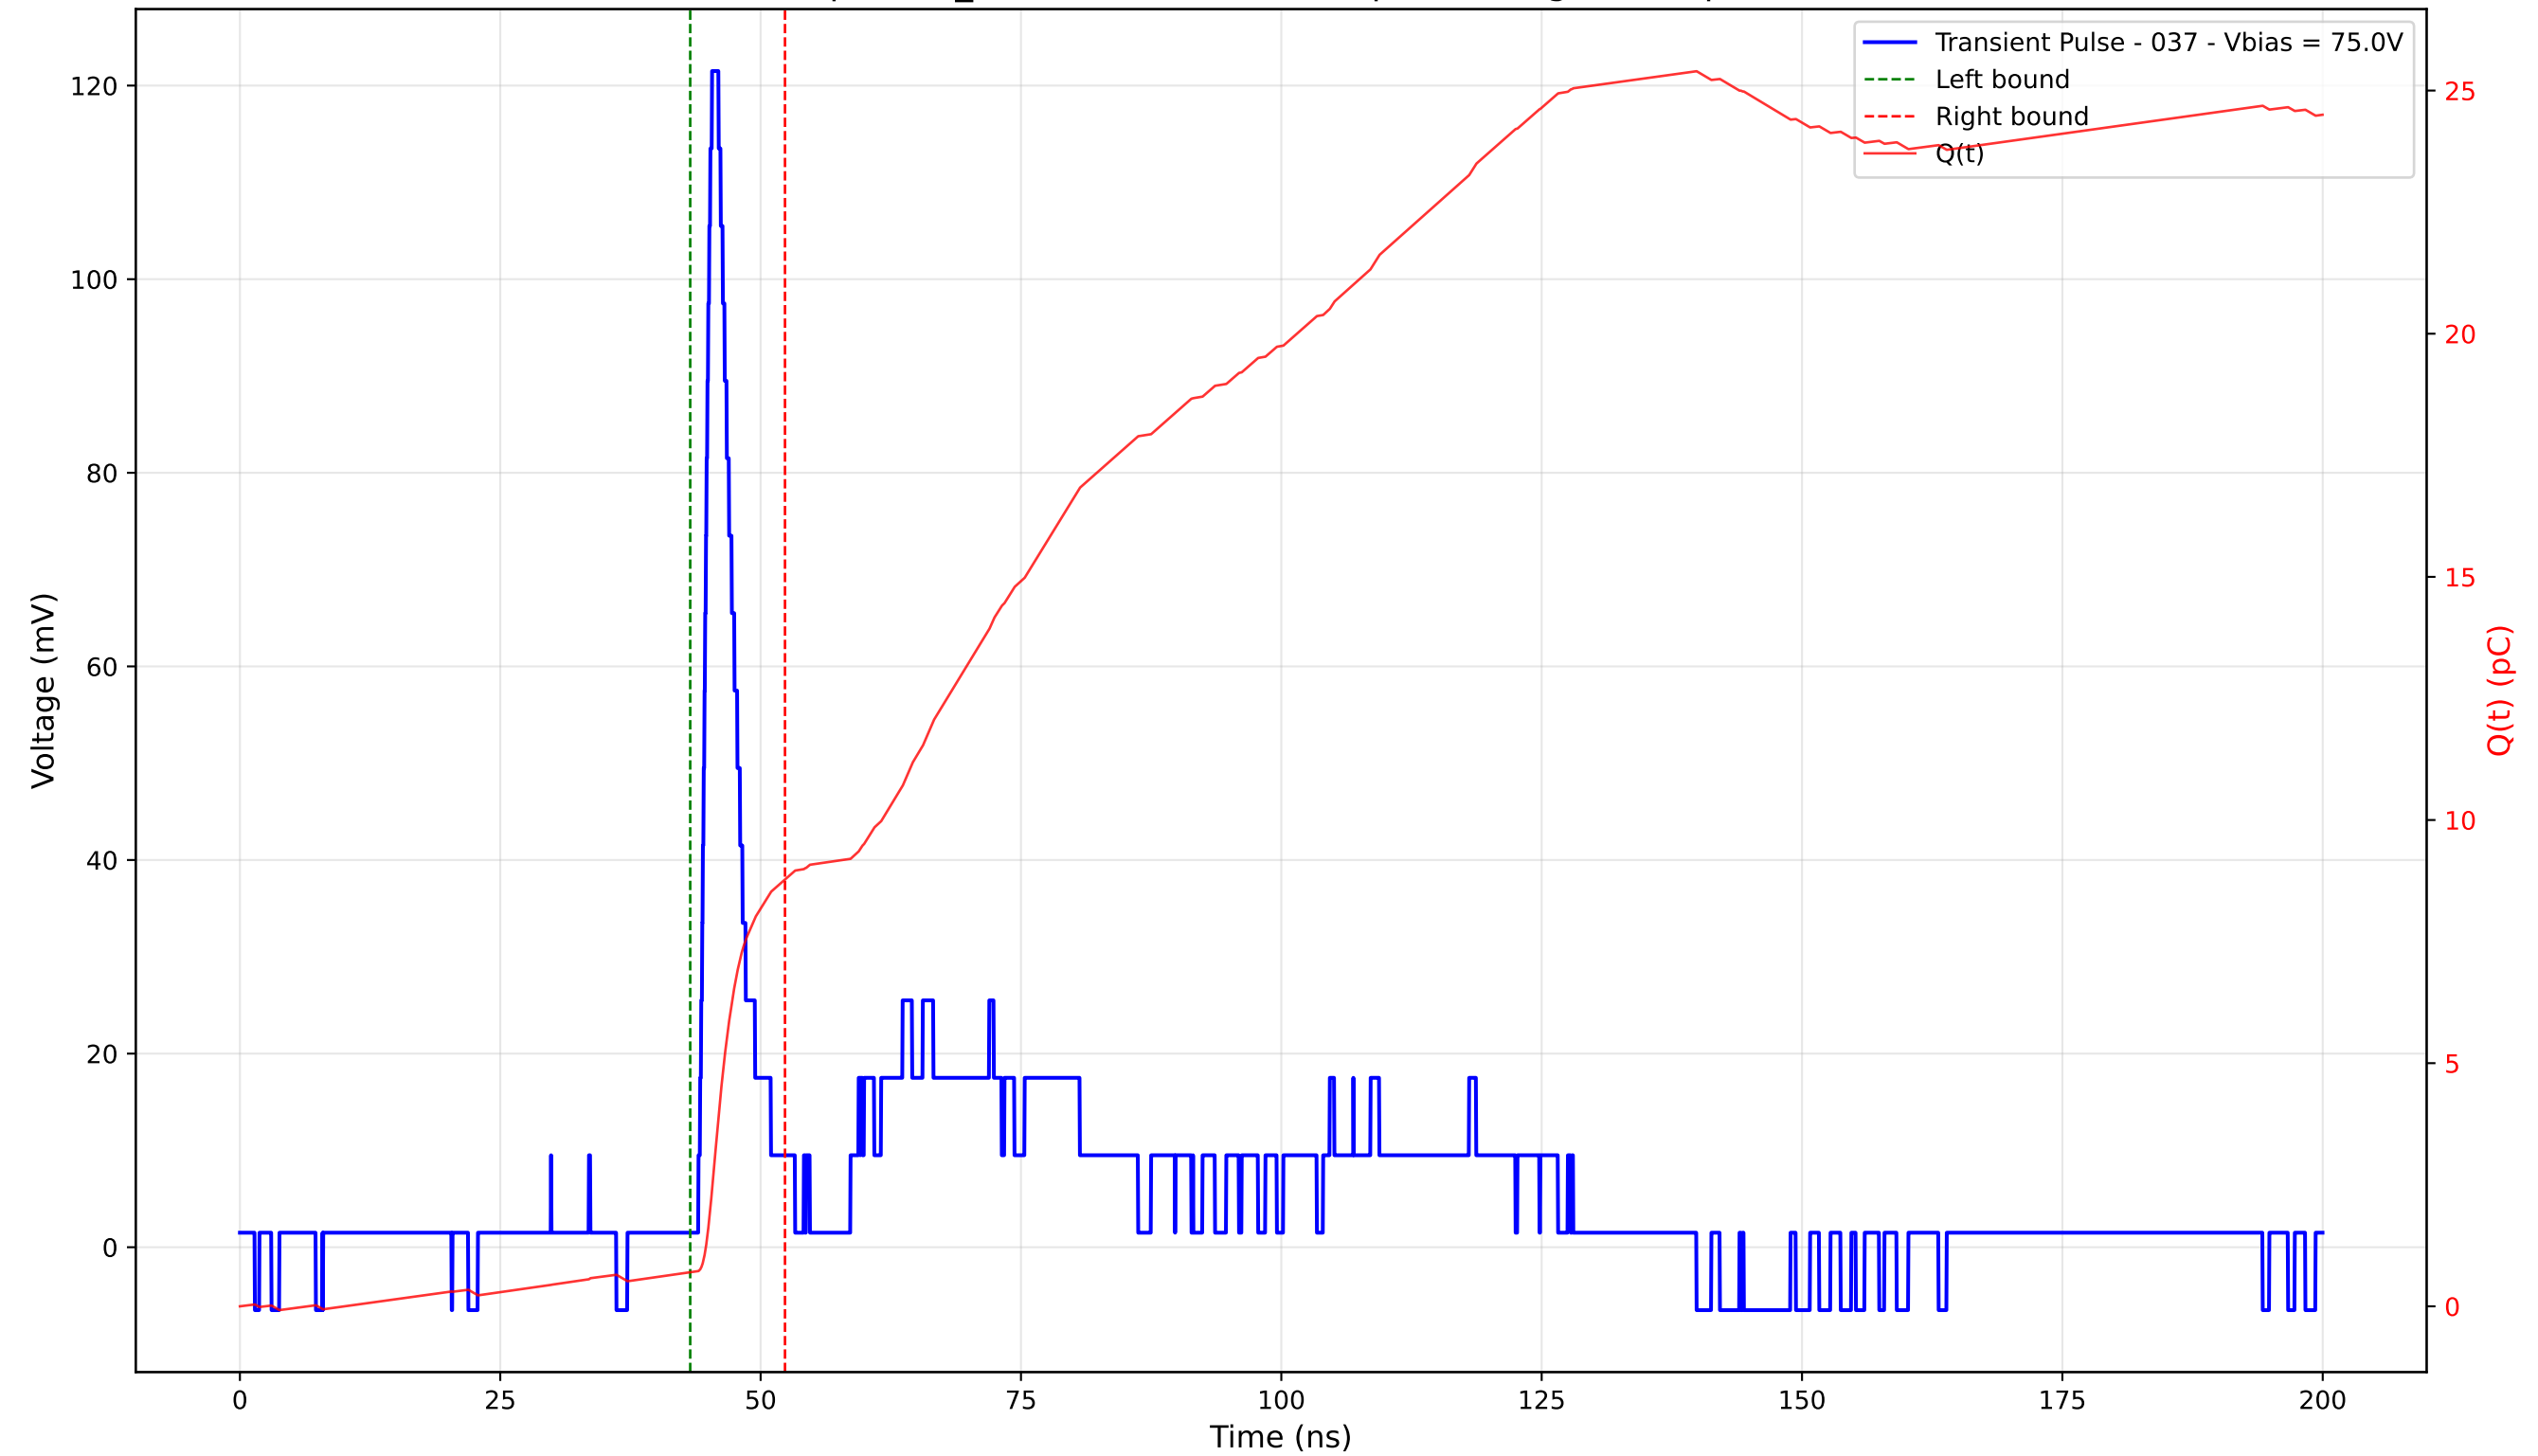


Transient Pulse - Sample: TD_4004 - Position: 400.0 μm - Charge: 6.19 pC - Rise Time: 1.10 ns

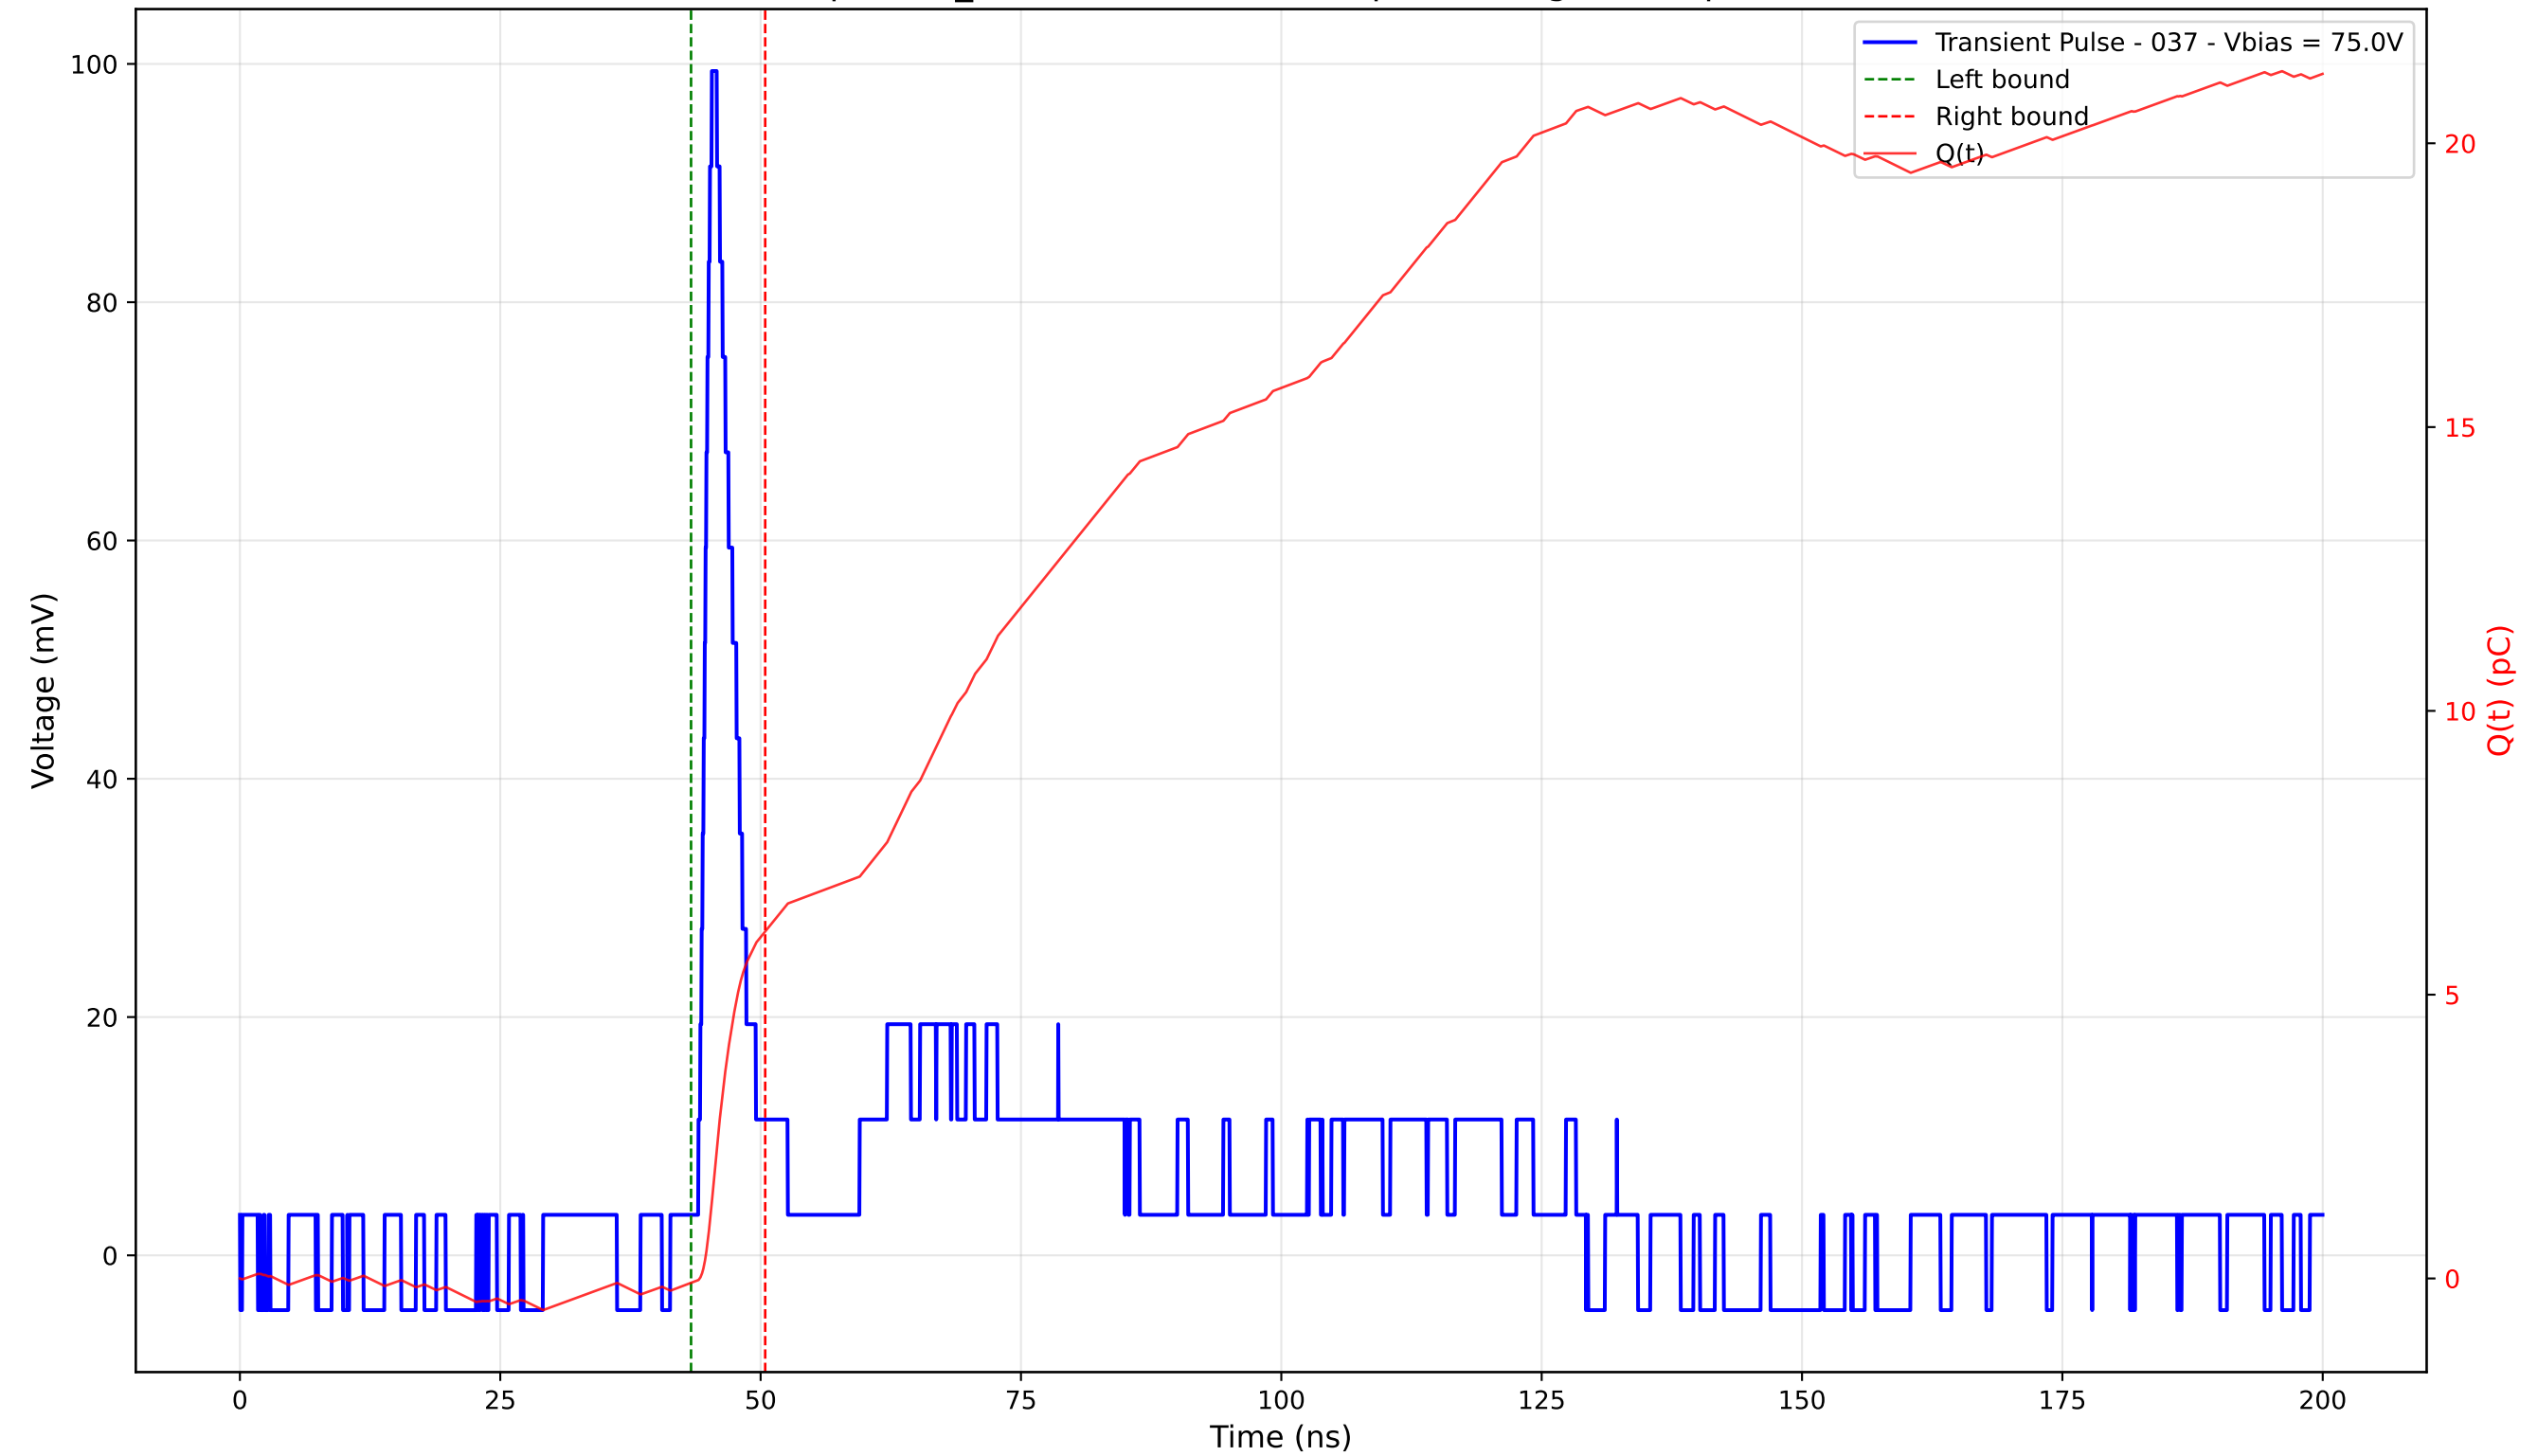


Transient Pulse - Sample: TD_4004 - Position: 405.0 μm - Charge: 5.72 pC - Rise Time: 1.03 ns

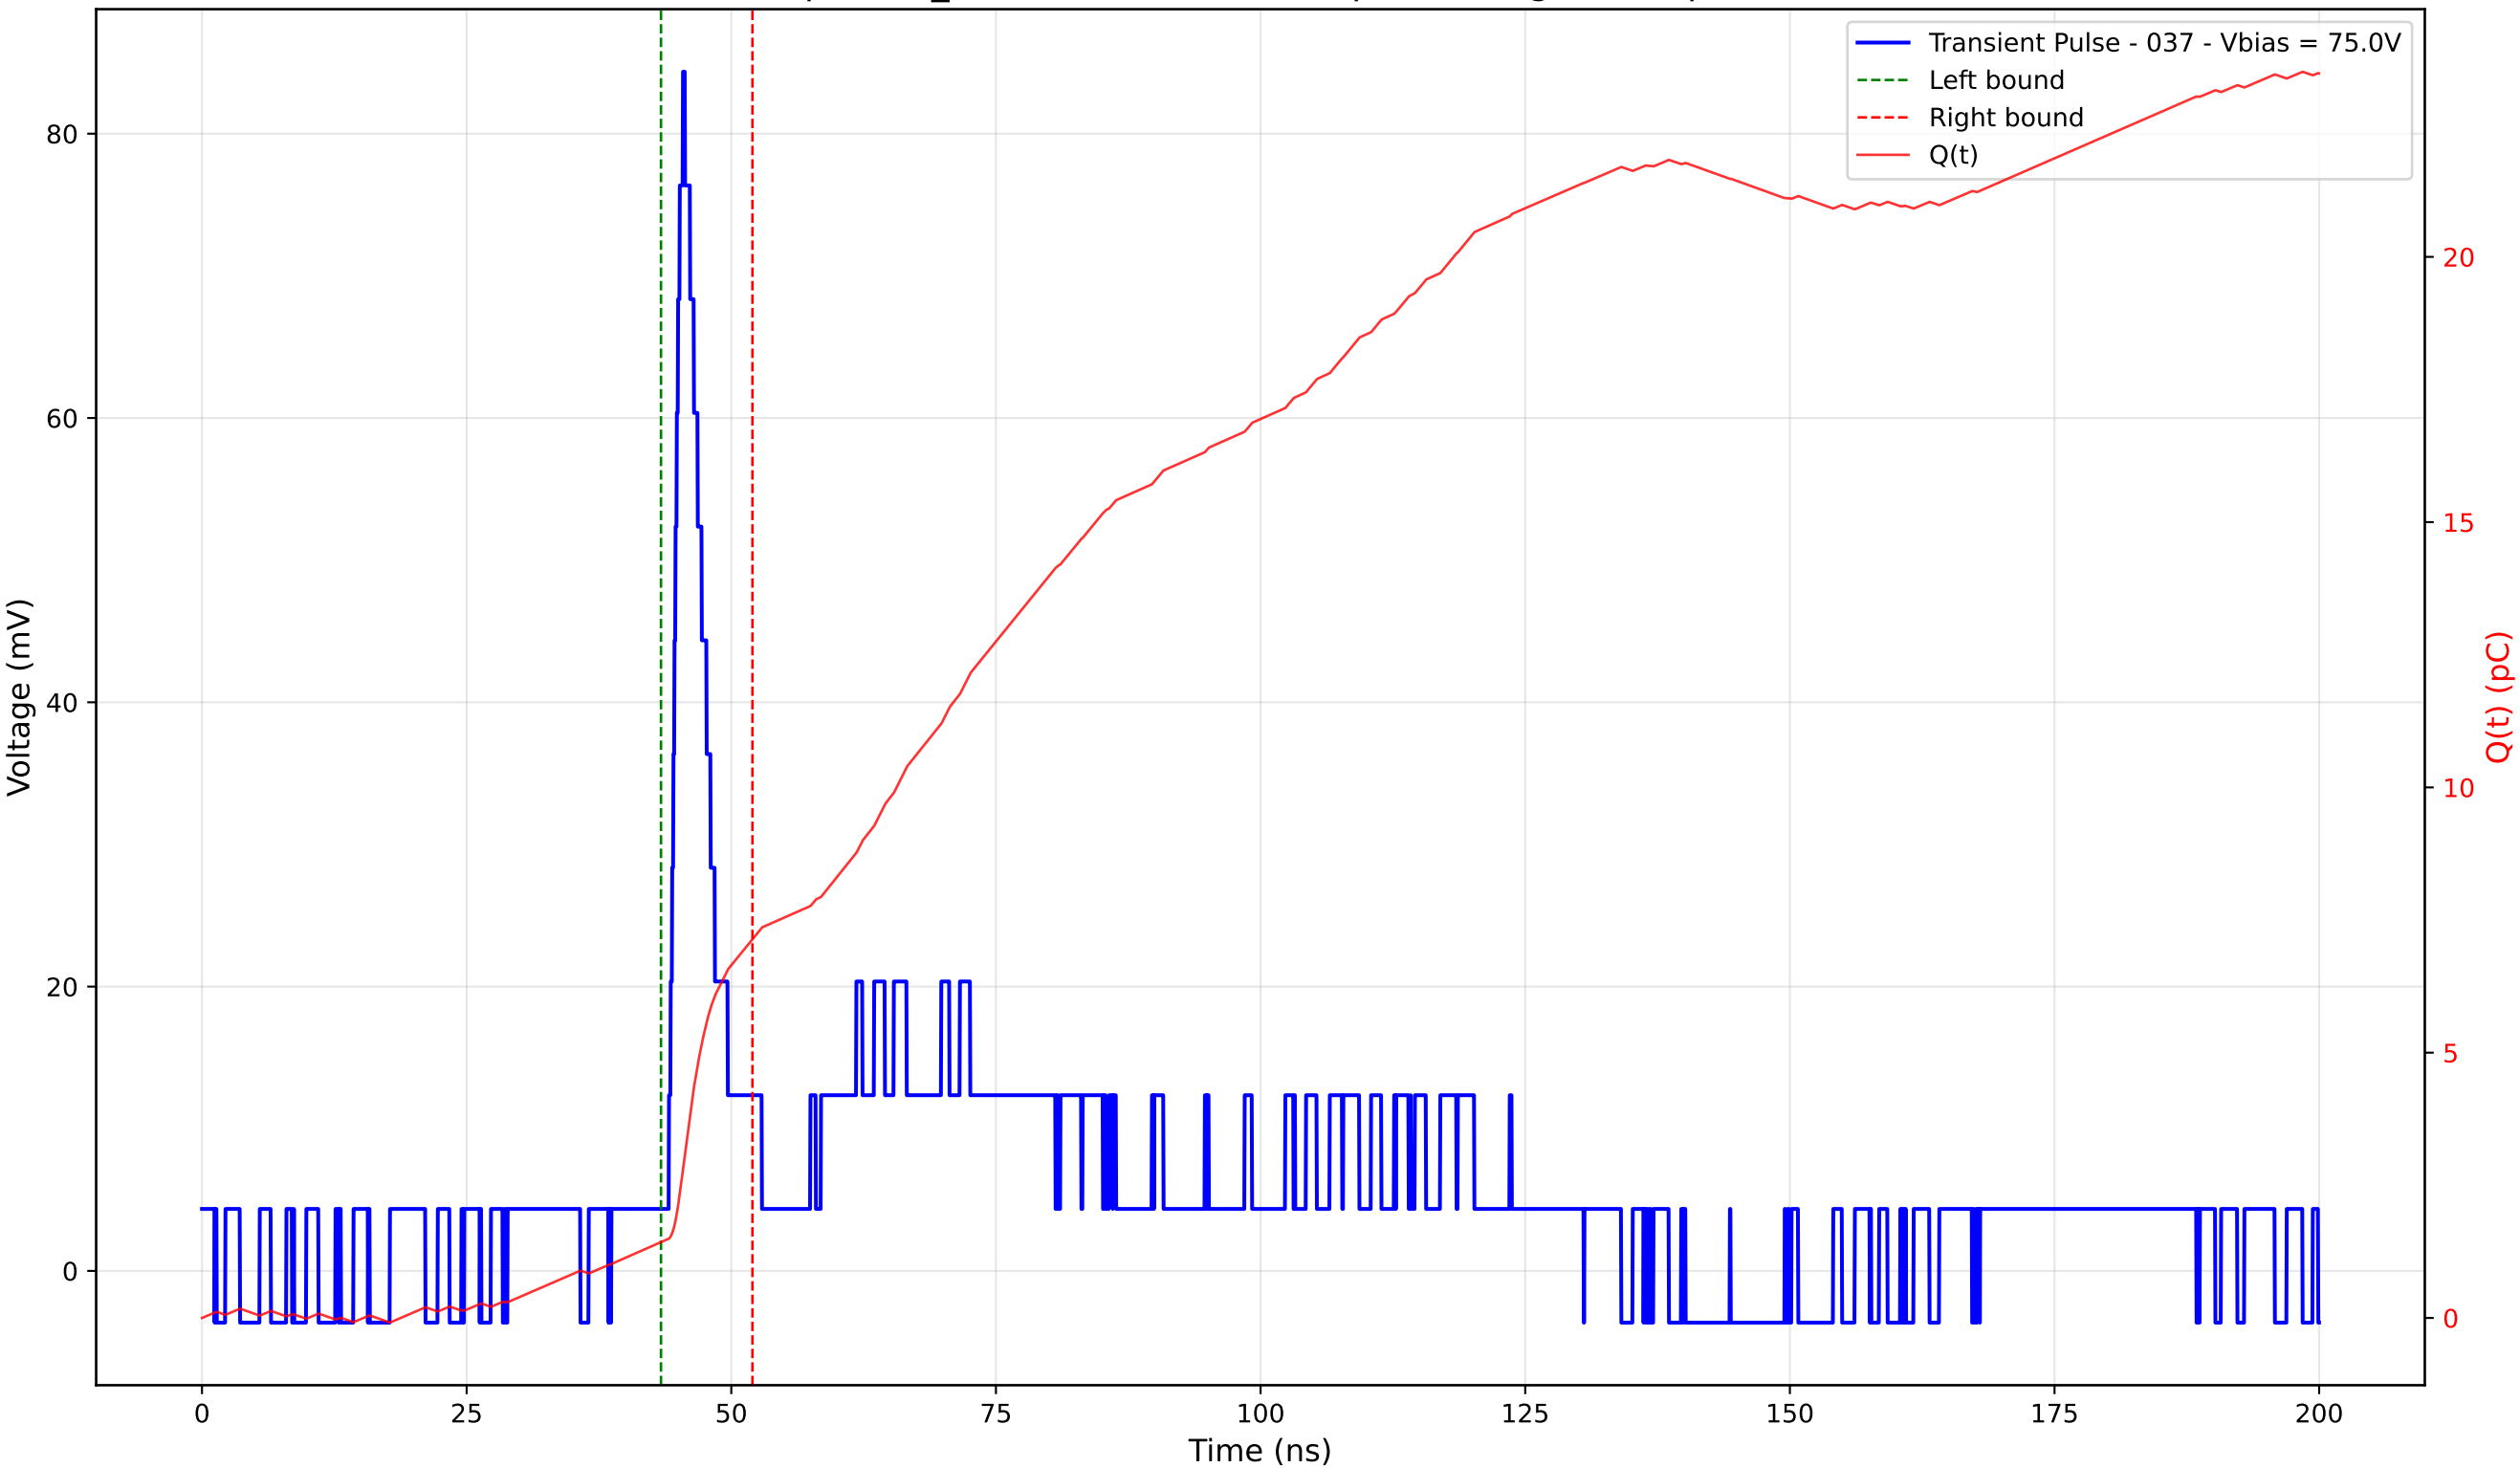


Transient Pulse - Sample: TD_4004 - Position: 410.0 μm - Charge: 4.71 pC - Rise Time: 1.30 ns

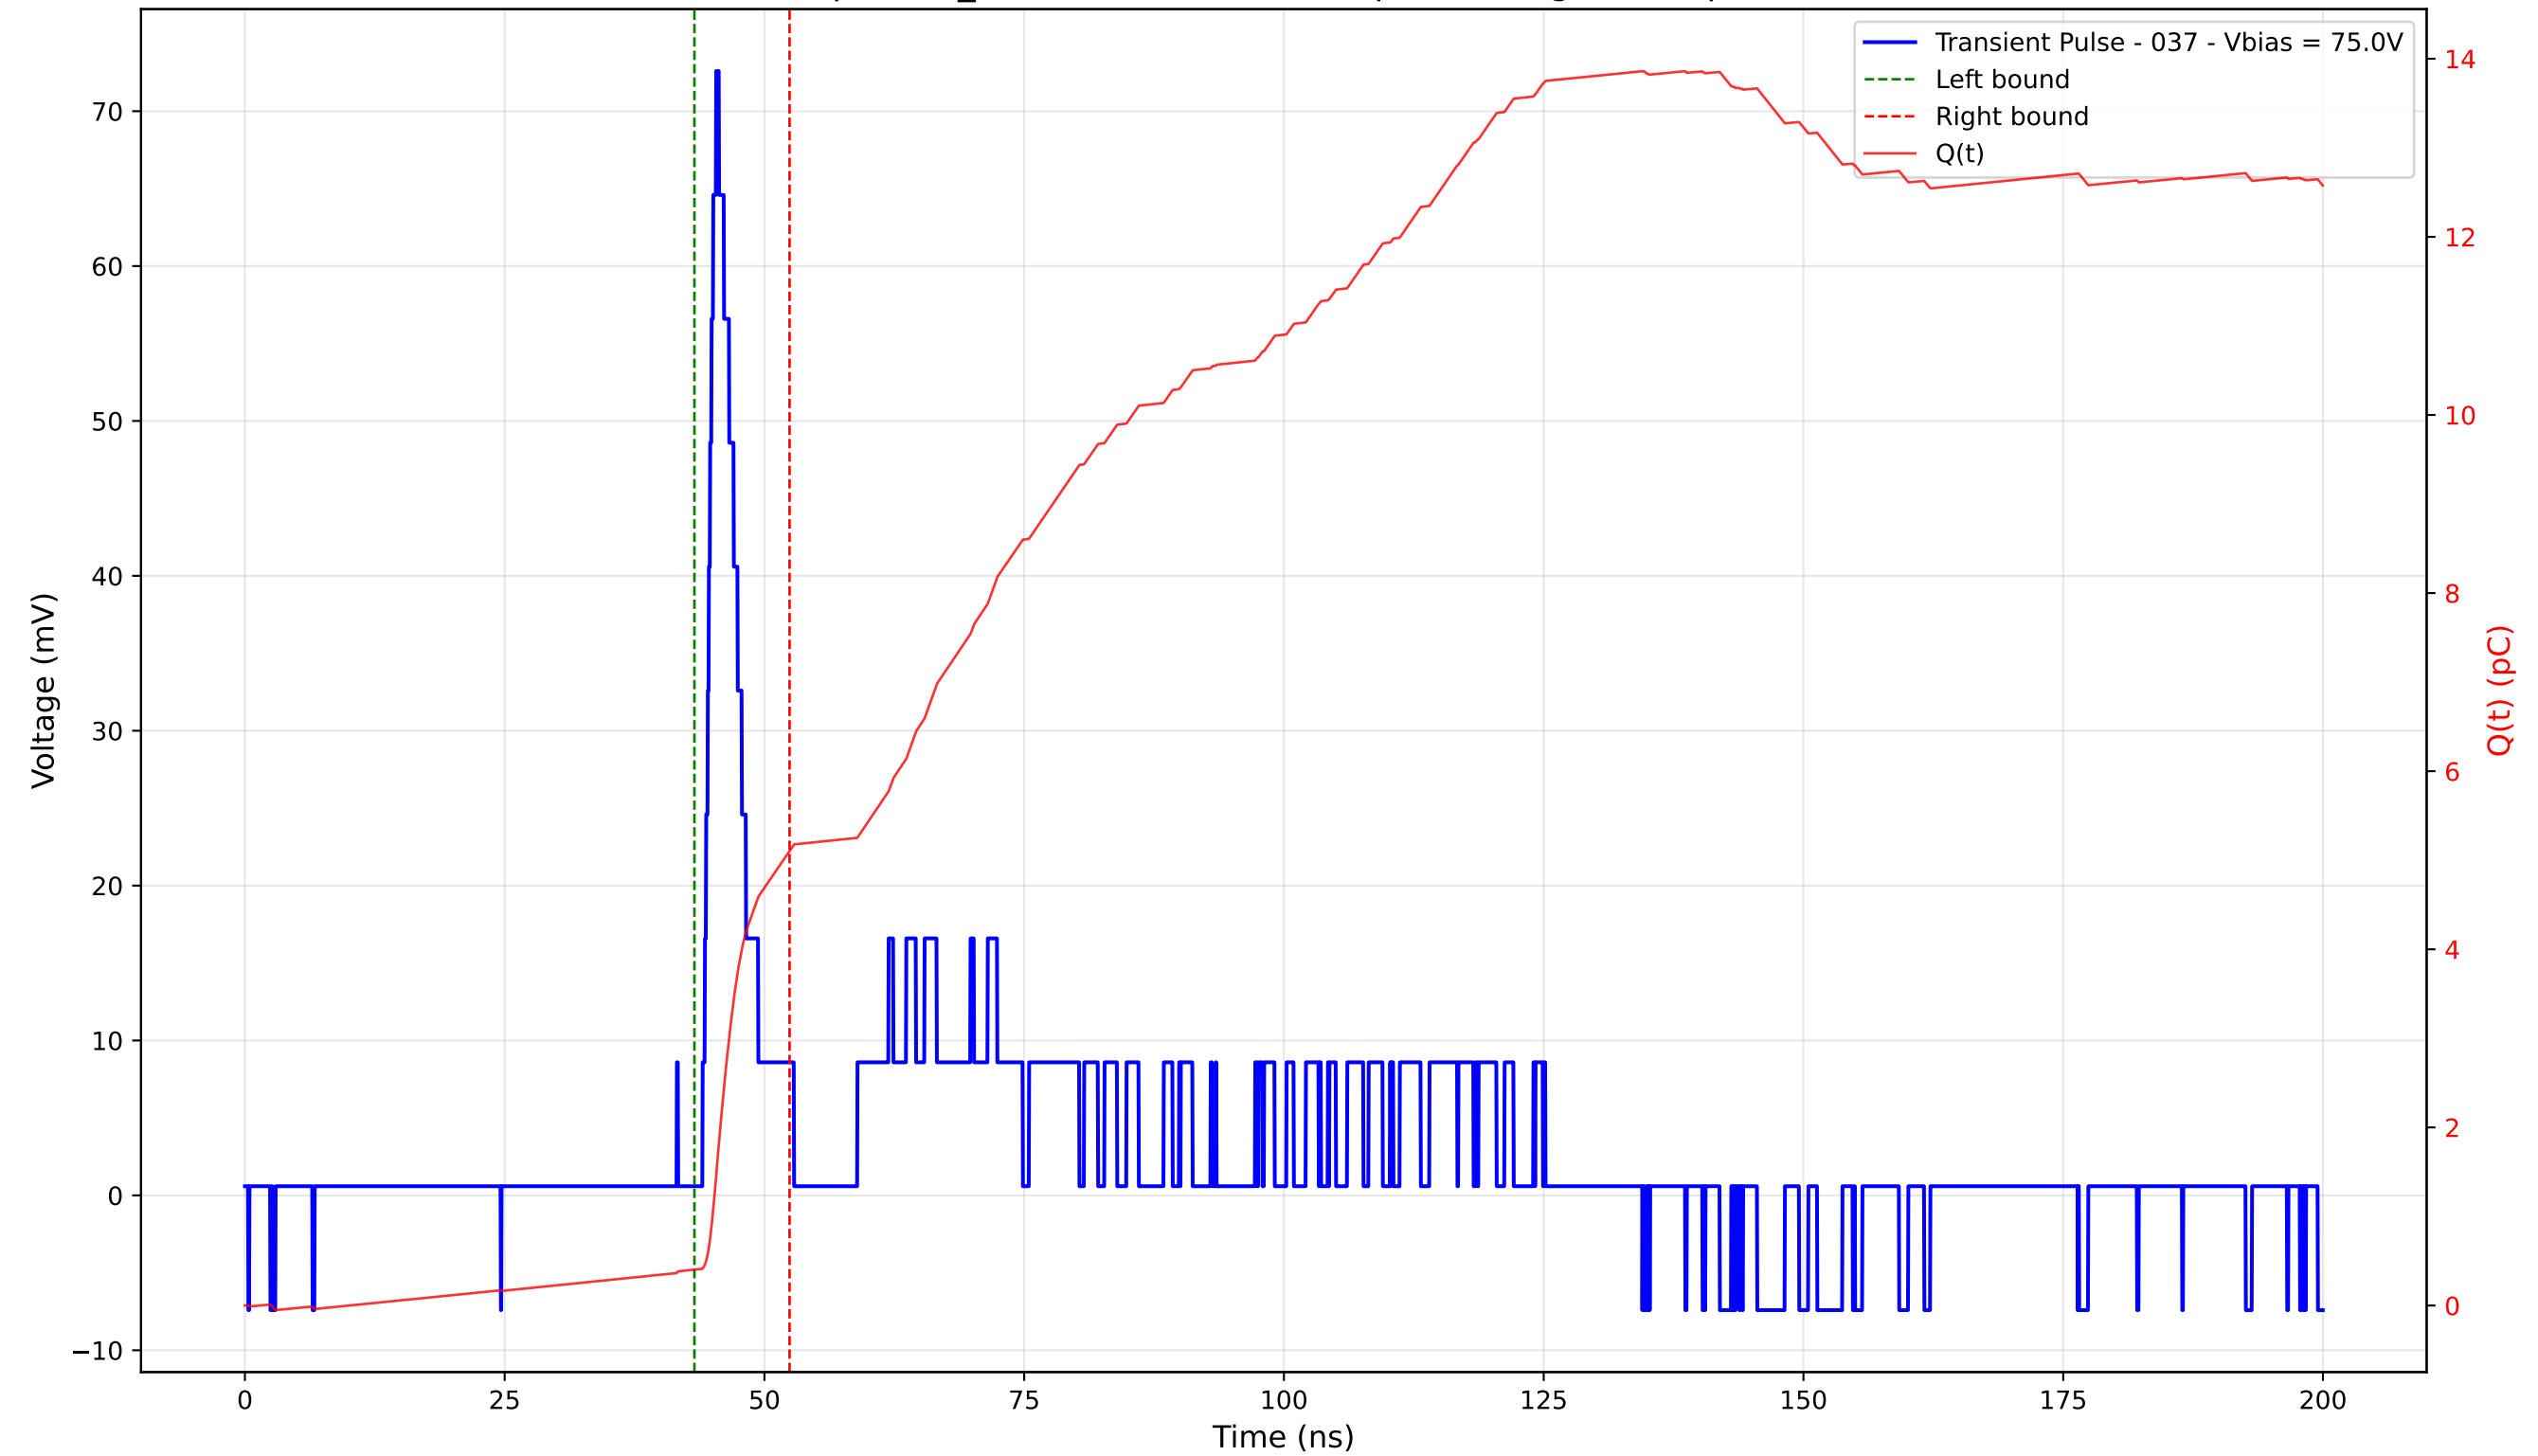


Transient Pulse - Sample: TD_4004 - Position: 415.0 μm - Charge: 3.49 pC - Rise Time: 1.11 ns

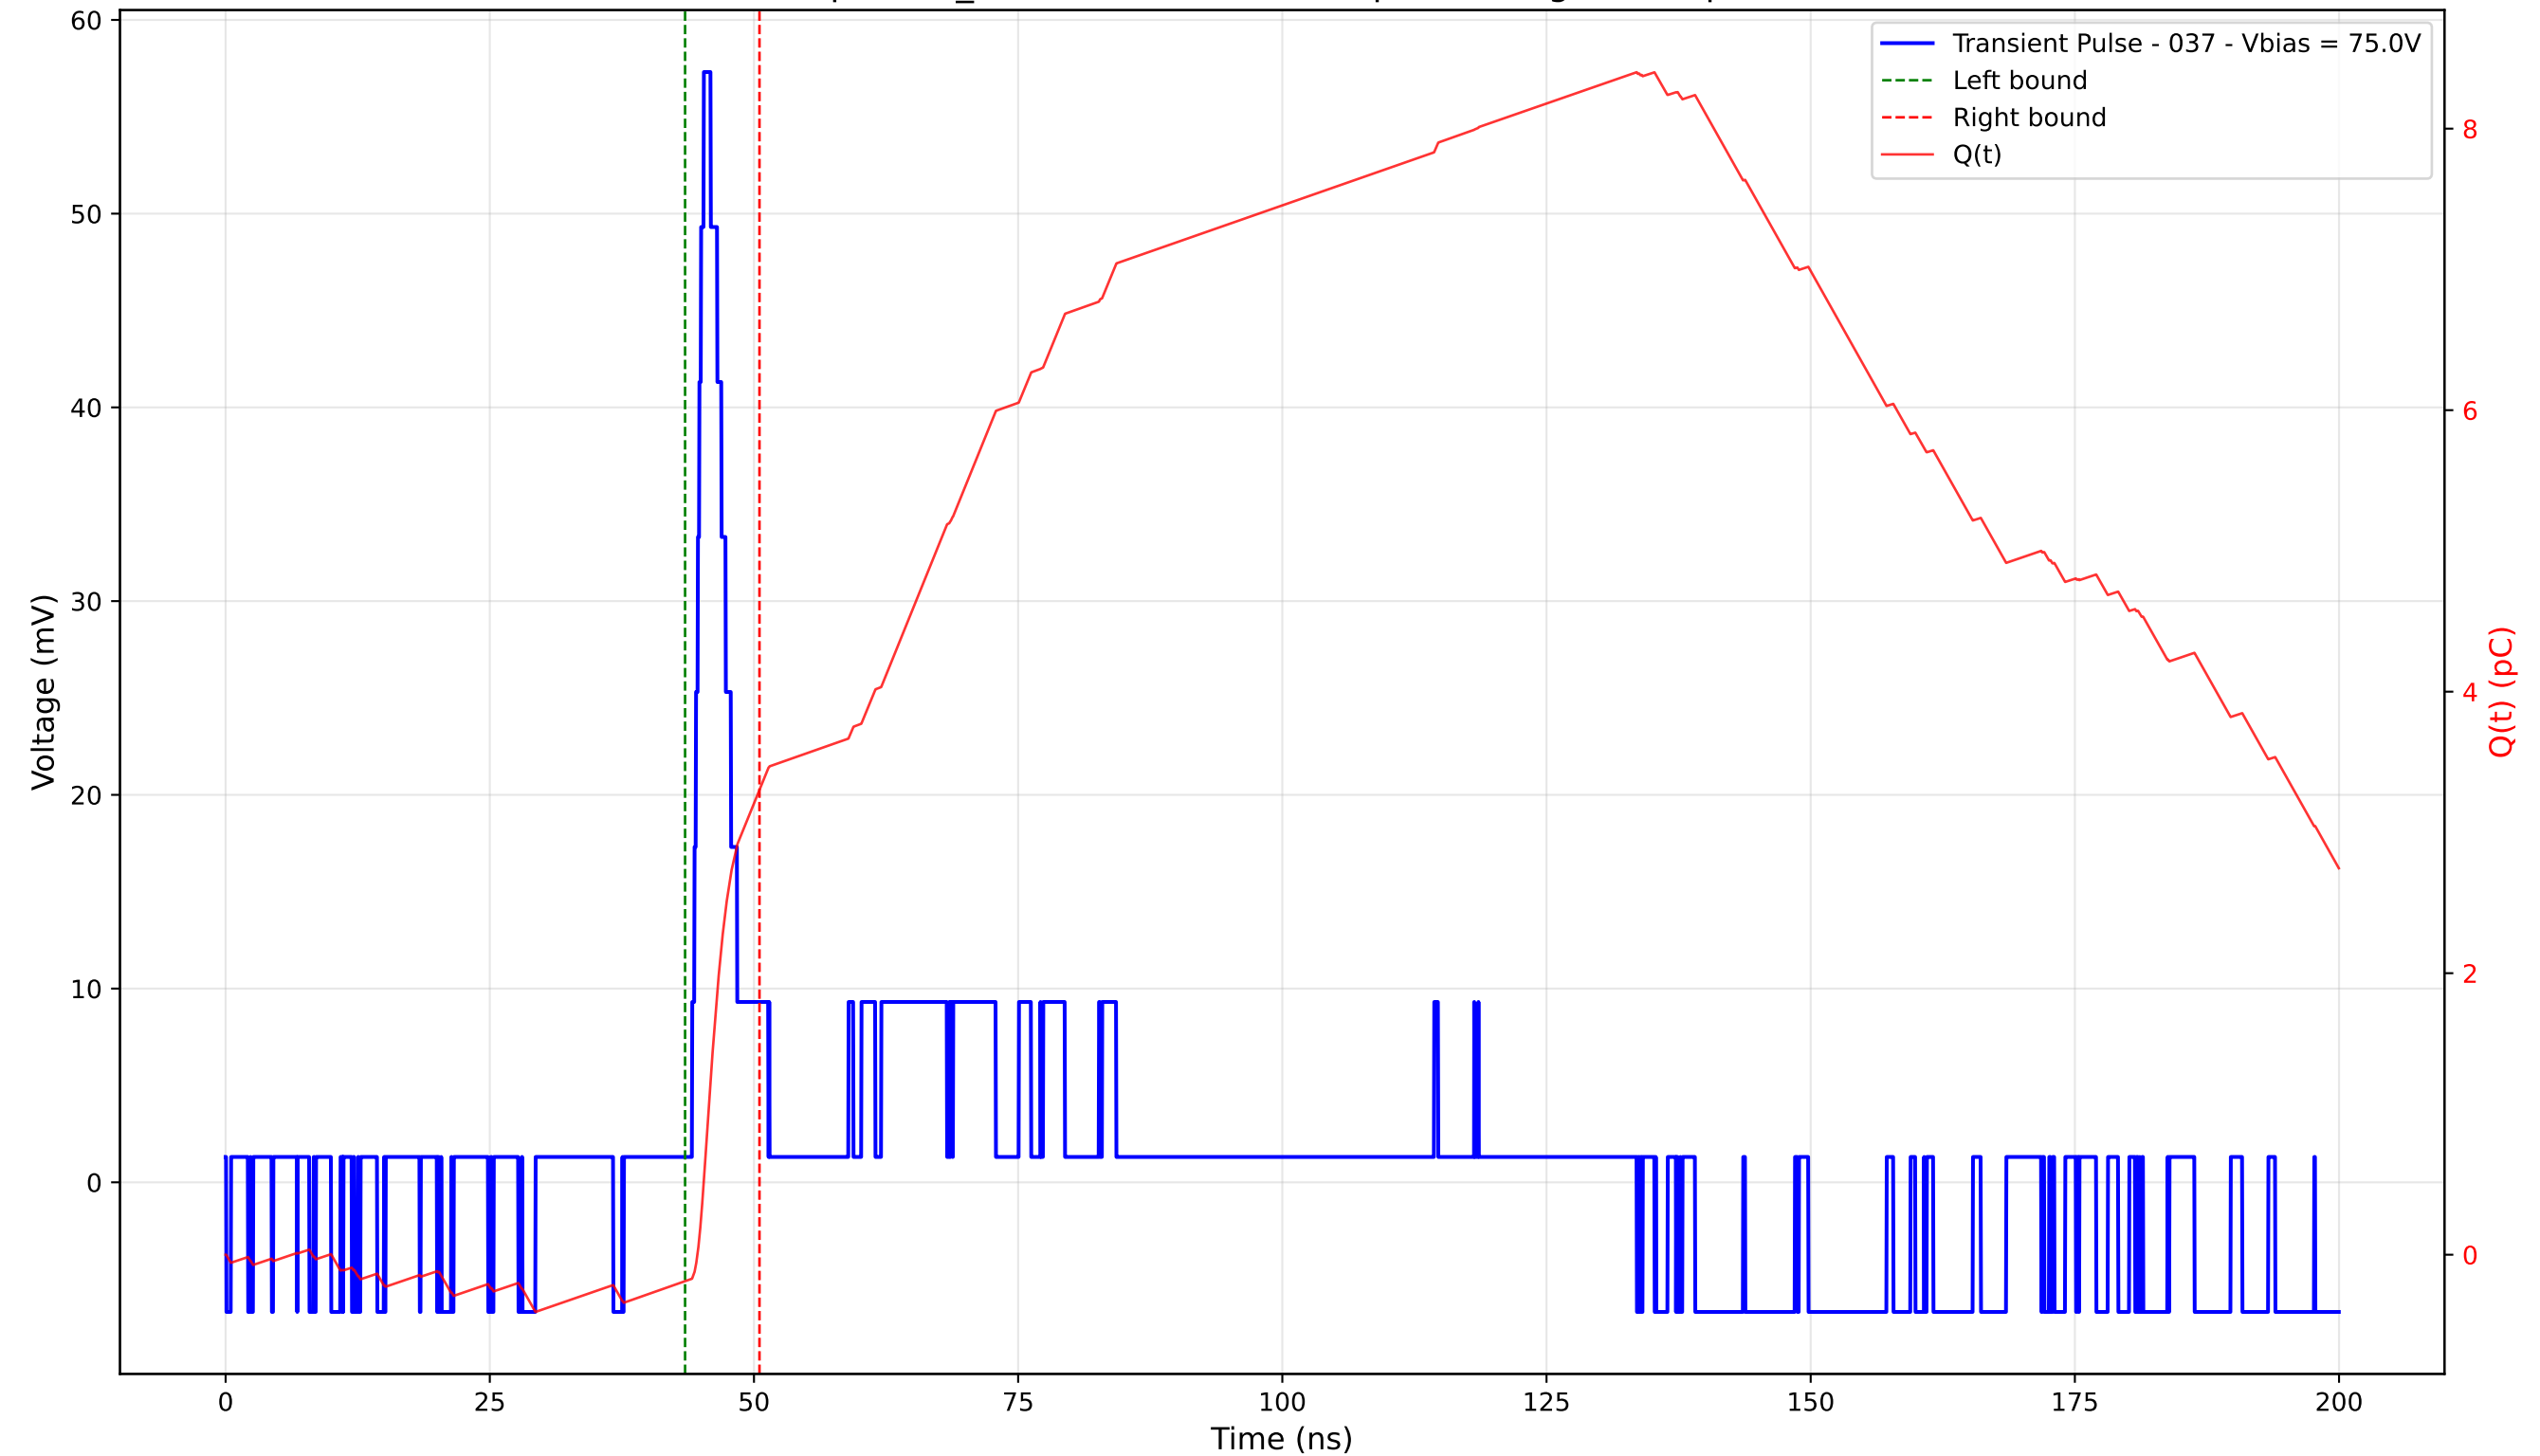


Transient Pulse - Sample: TD_4004 - Position: 420.0 μm - Charge: 2.30 pC - Rise Time: 1.07 ns

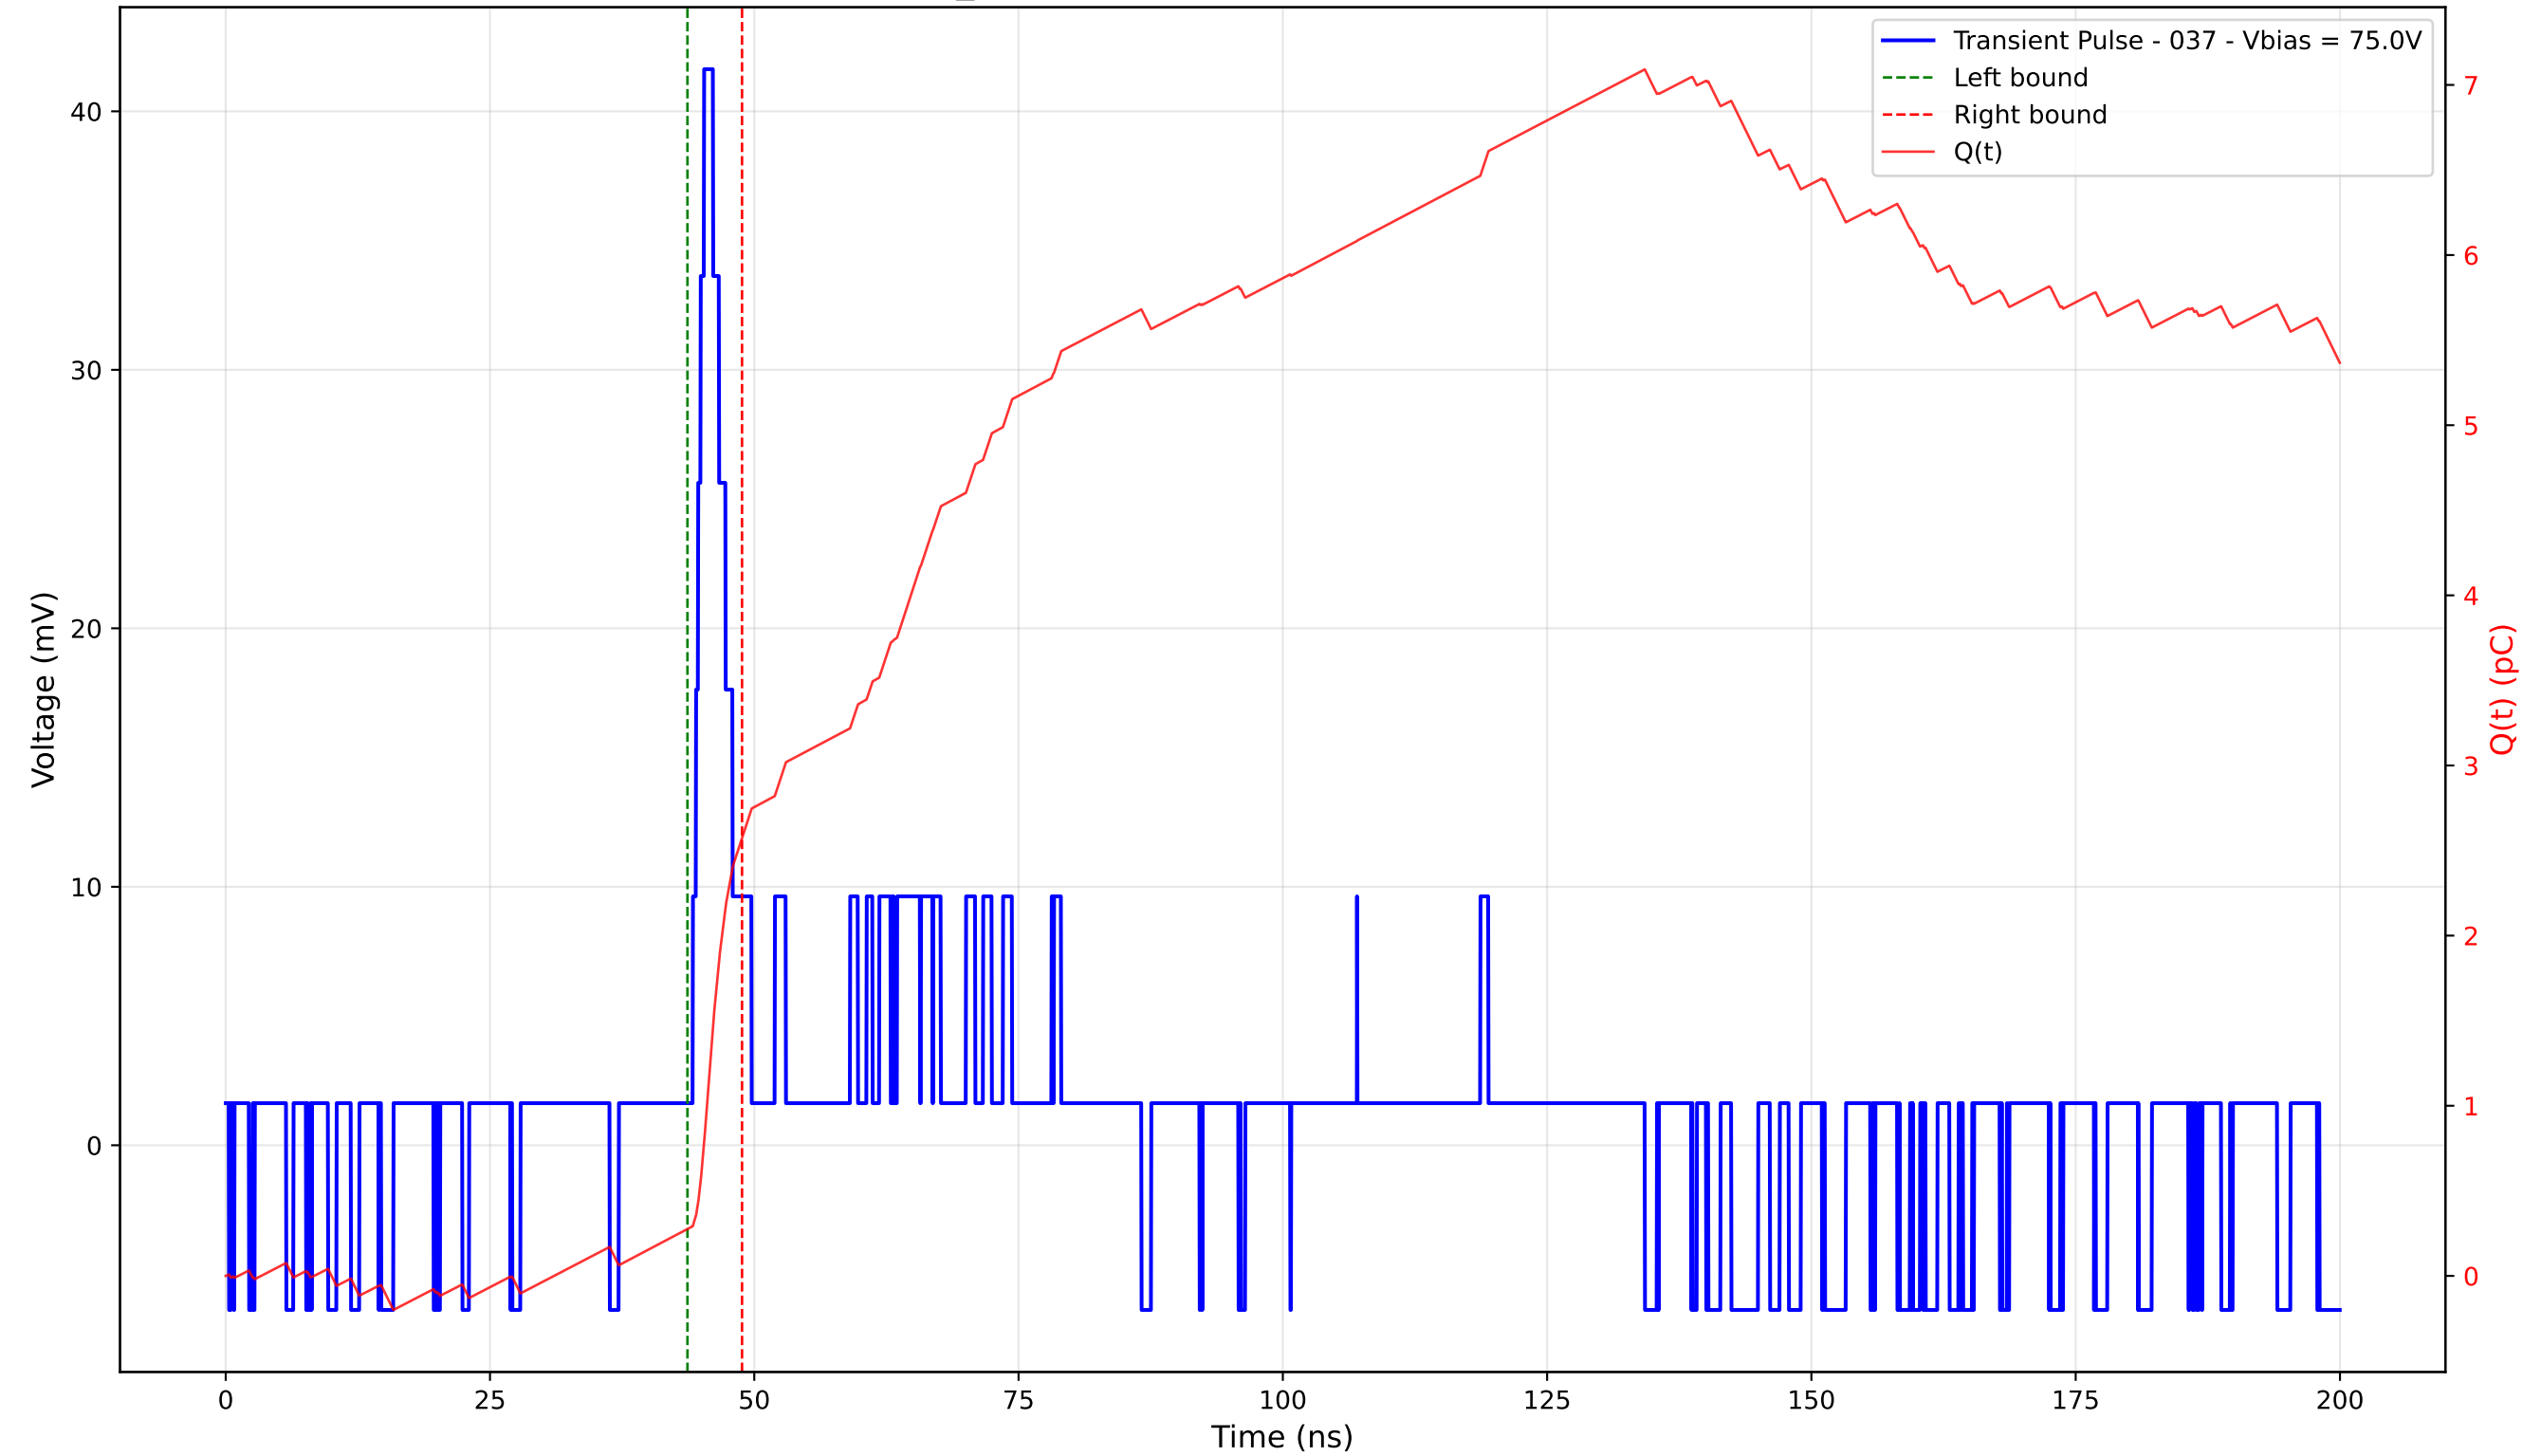

Transient Pulse - Sample: TD_4004 - Position: 425.0 μm - Charge: 1.41 pC - Rise Time: 0.00 ns (N/A)

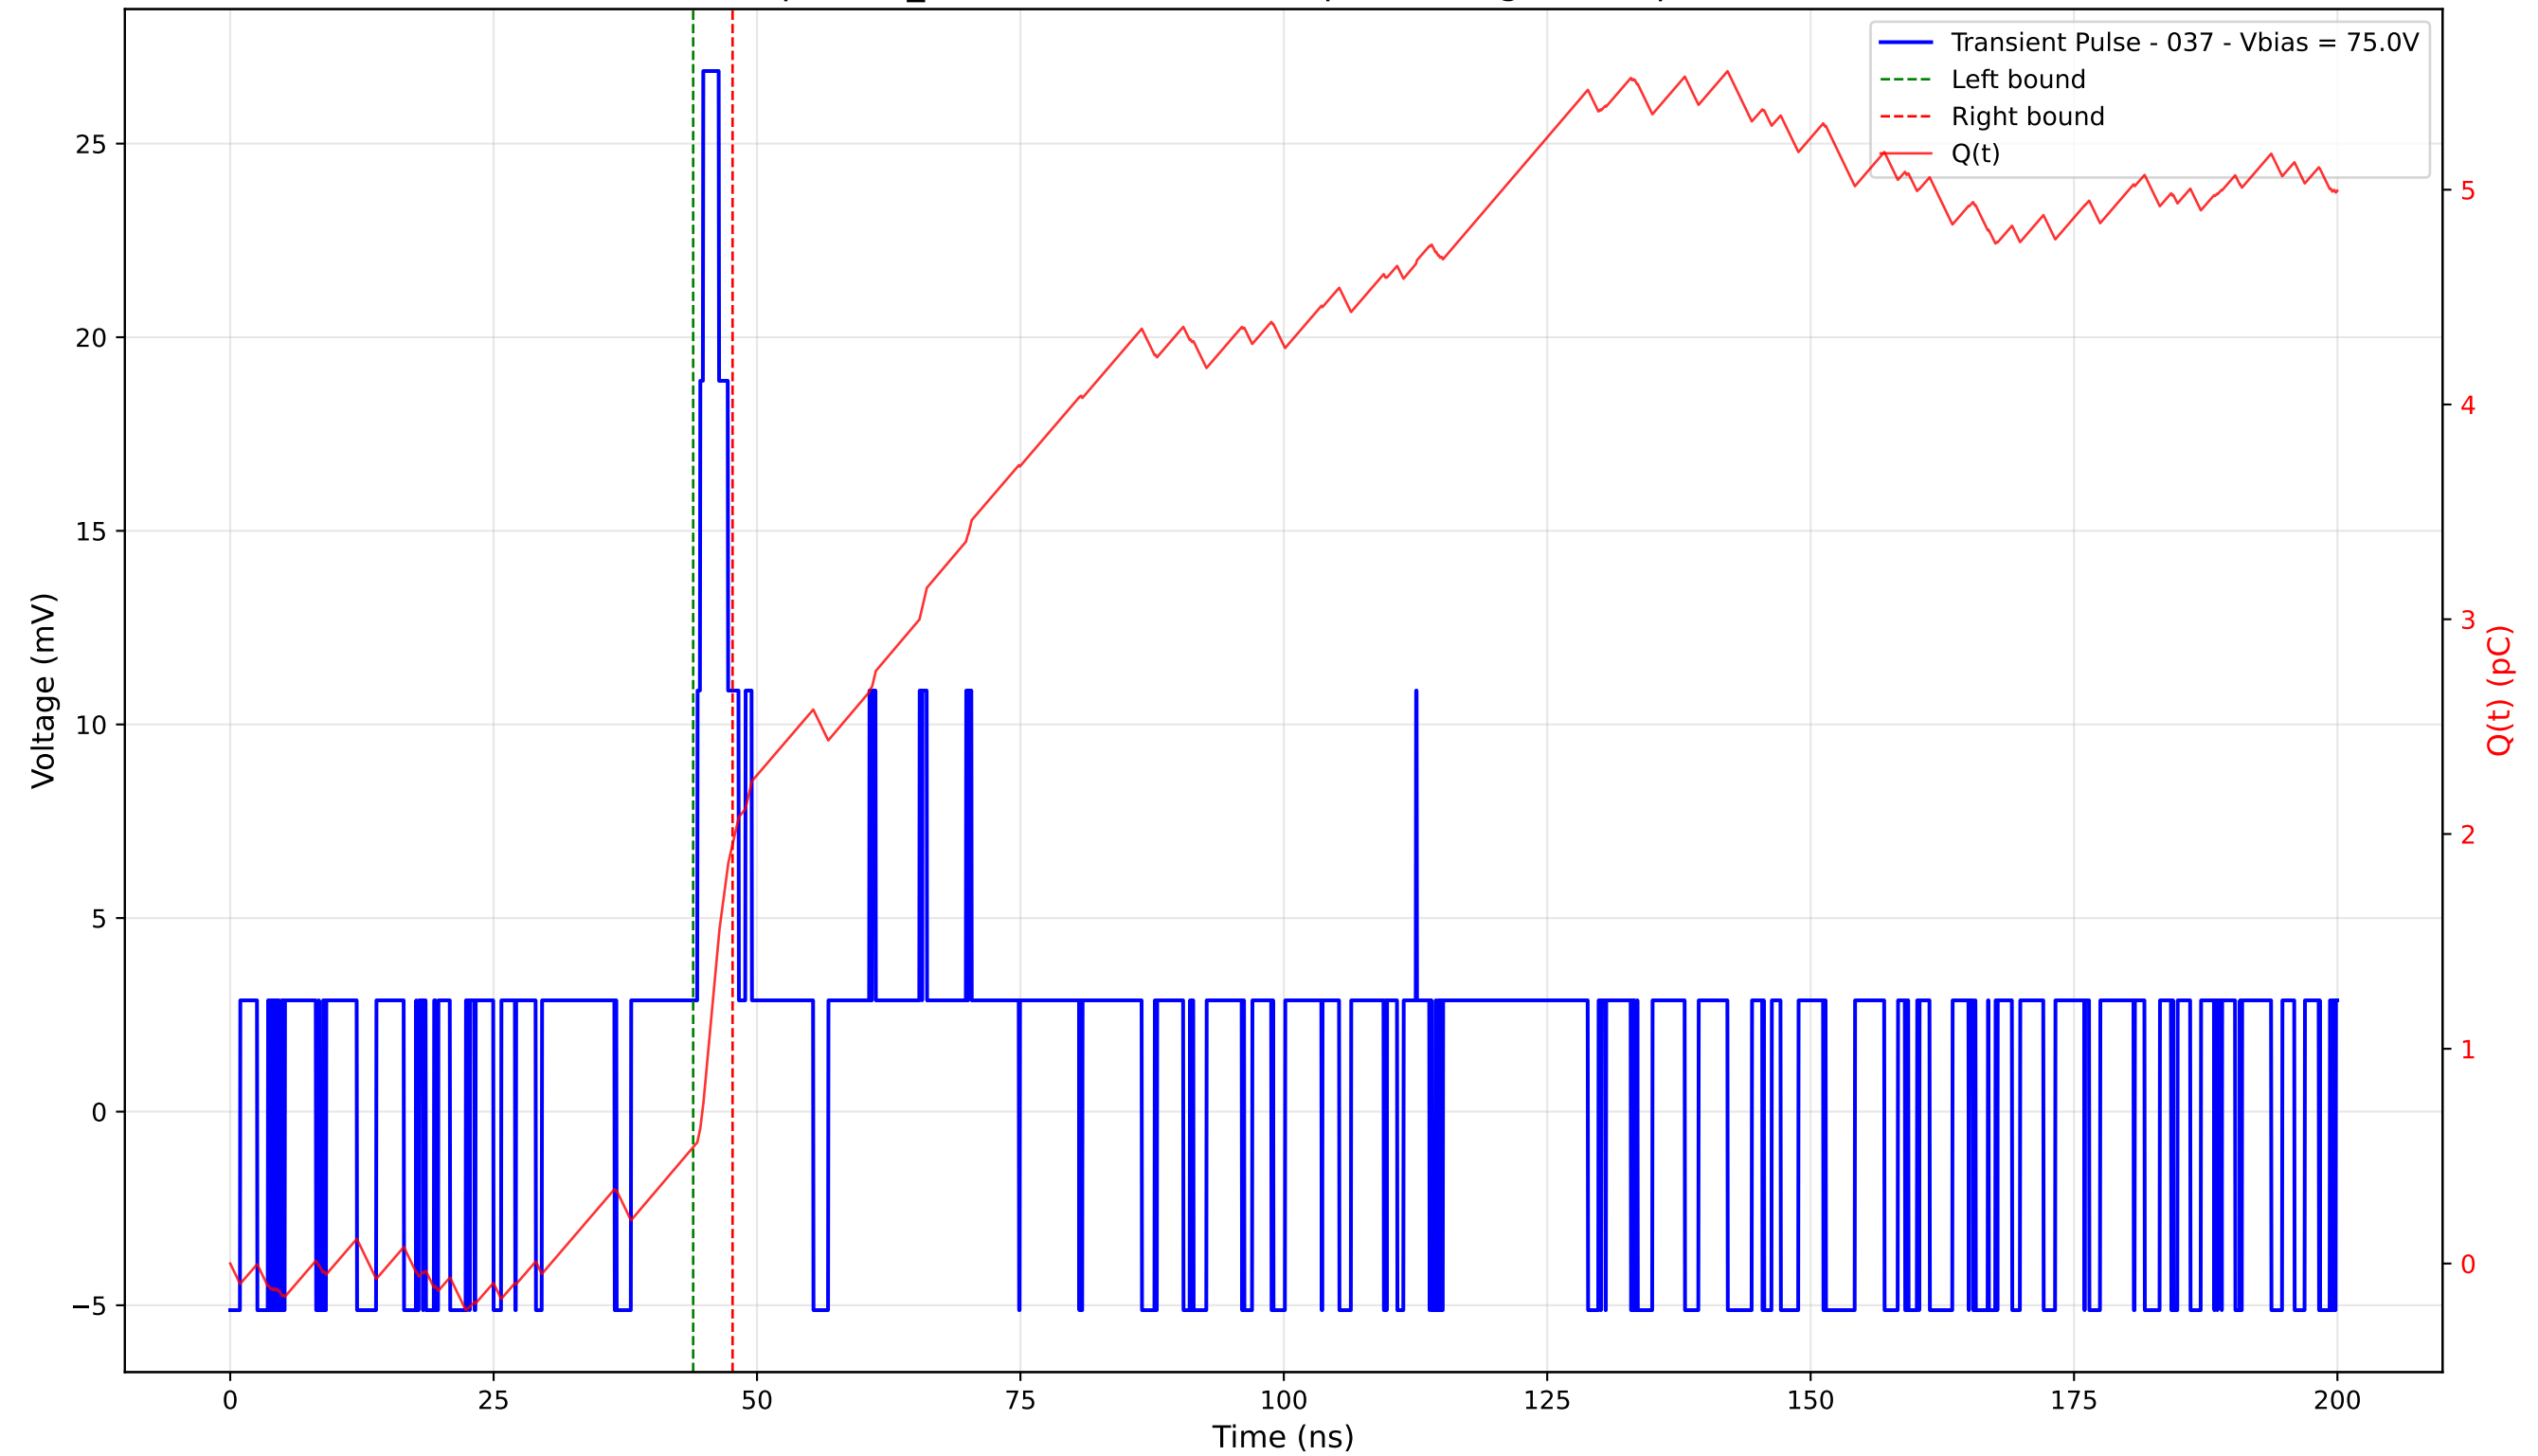

Transient Pulse - Sample: TD_4004 - Position: 430.0 μm - Charge: 1.52 pC - Rise Time: 0.00 ns (N/A)

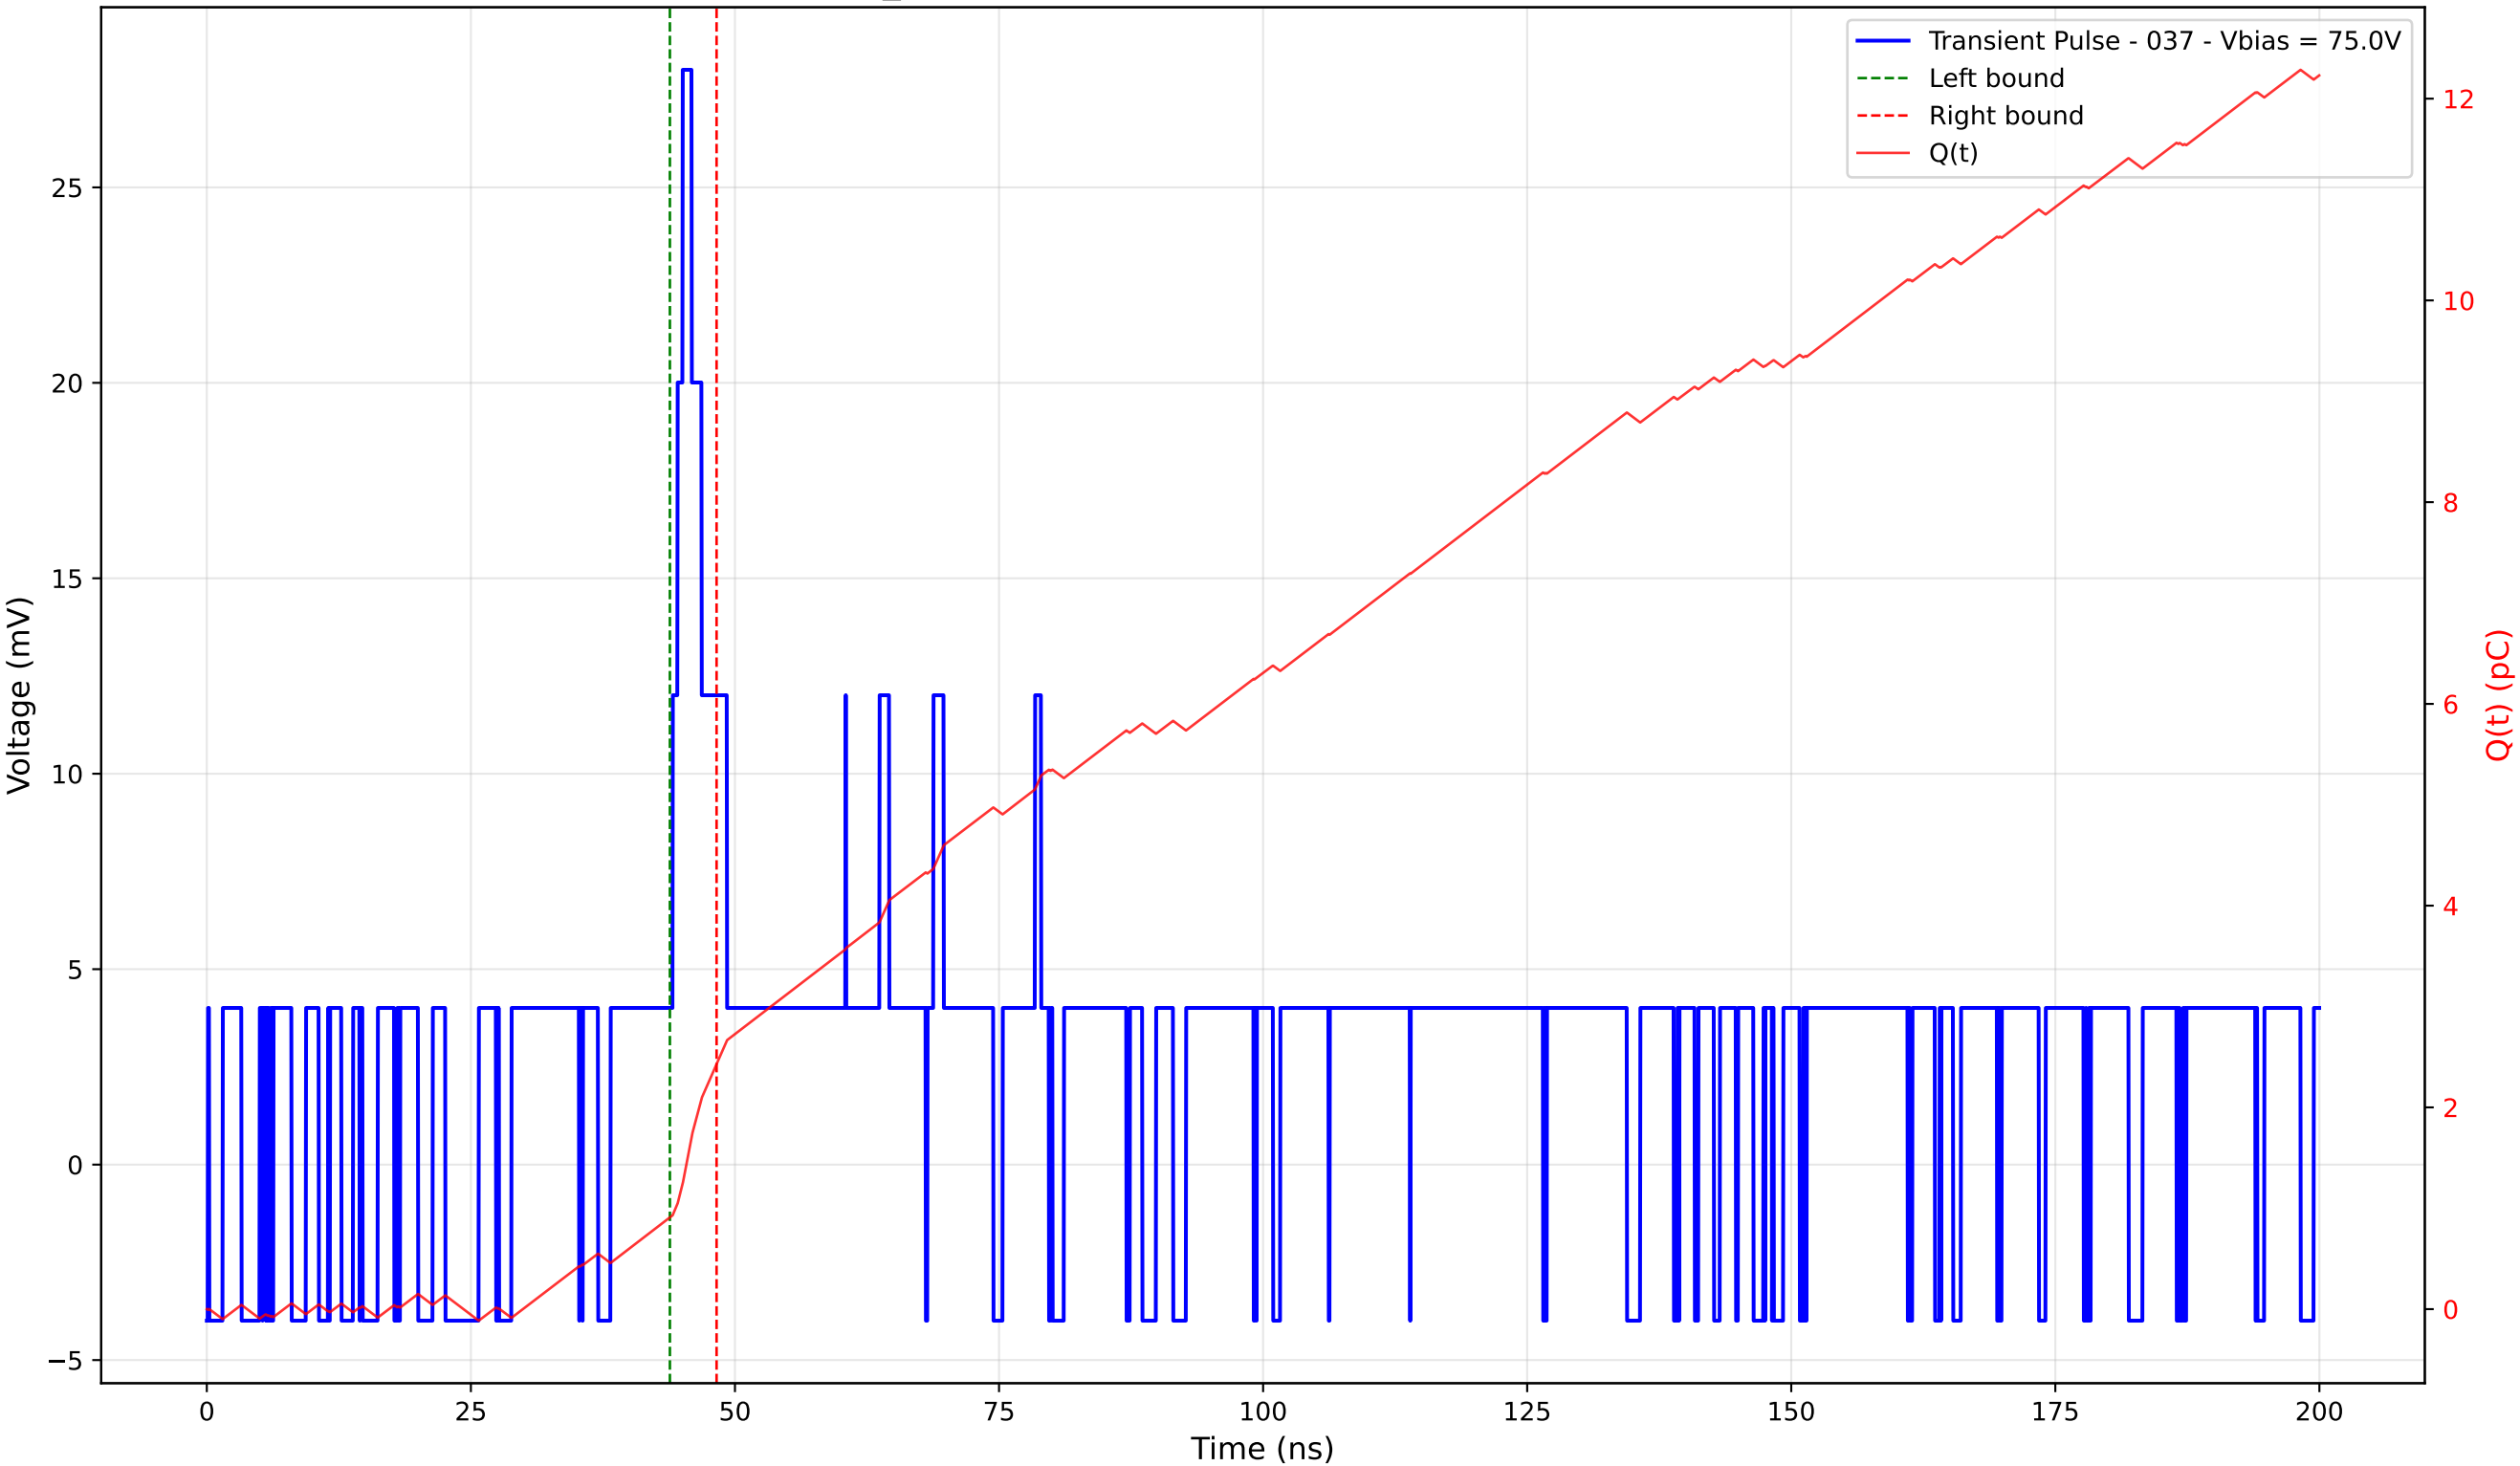

Transient Pulse - Sample: TD_4004 - Position: 435.0 μm - Charge: 1.95 pC - Rise Time: 6.25 ns

