


TCT Run 038 Summary

Parameter	Value
Run	Run038
Surface	N/A
Edge	x
Sample	TD_4004
Vbias (V)	50.0
DAC (%)	56.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\Run038
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

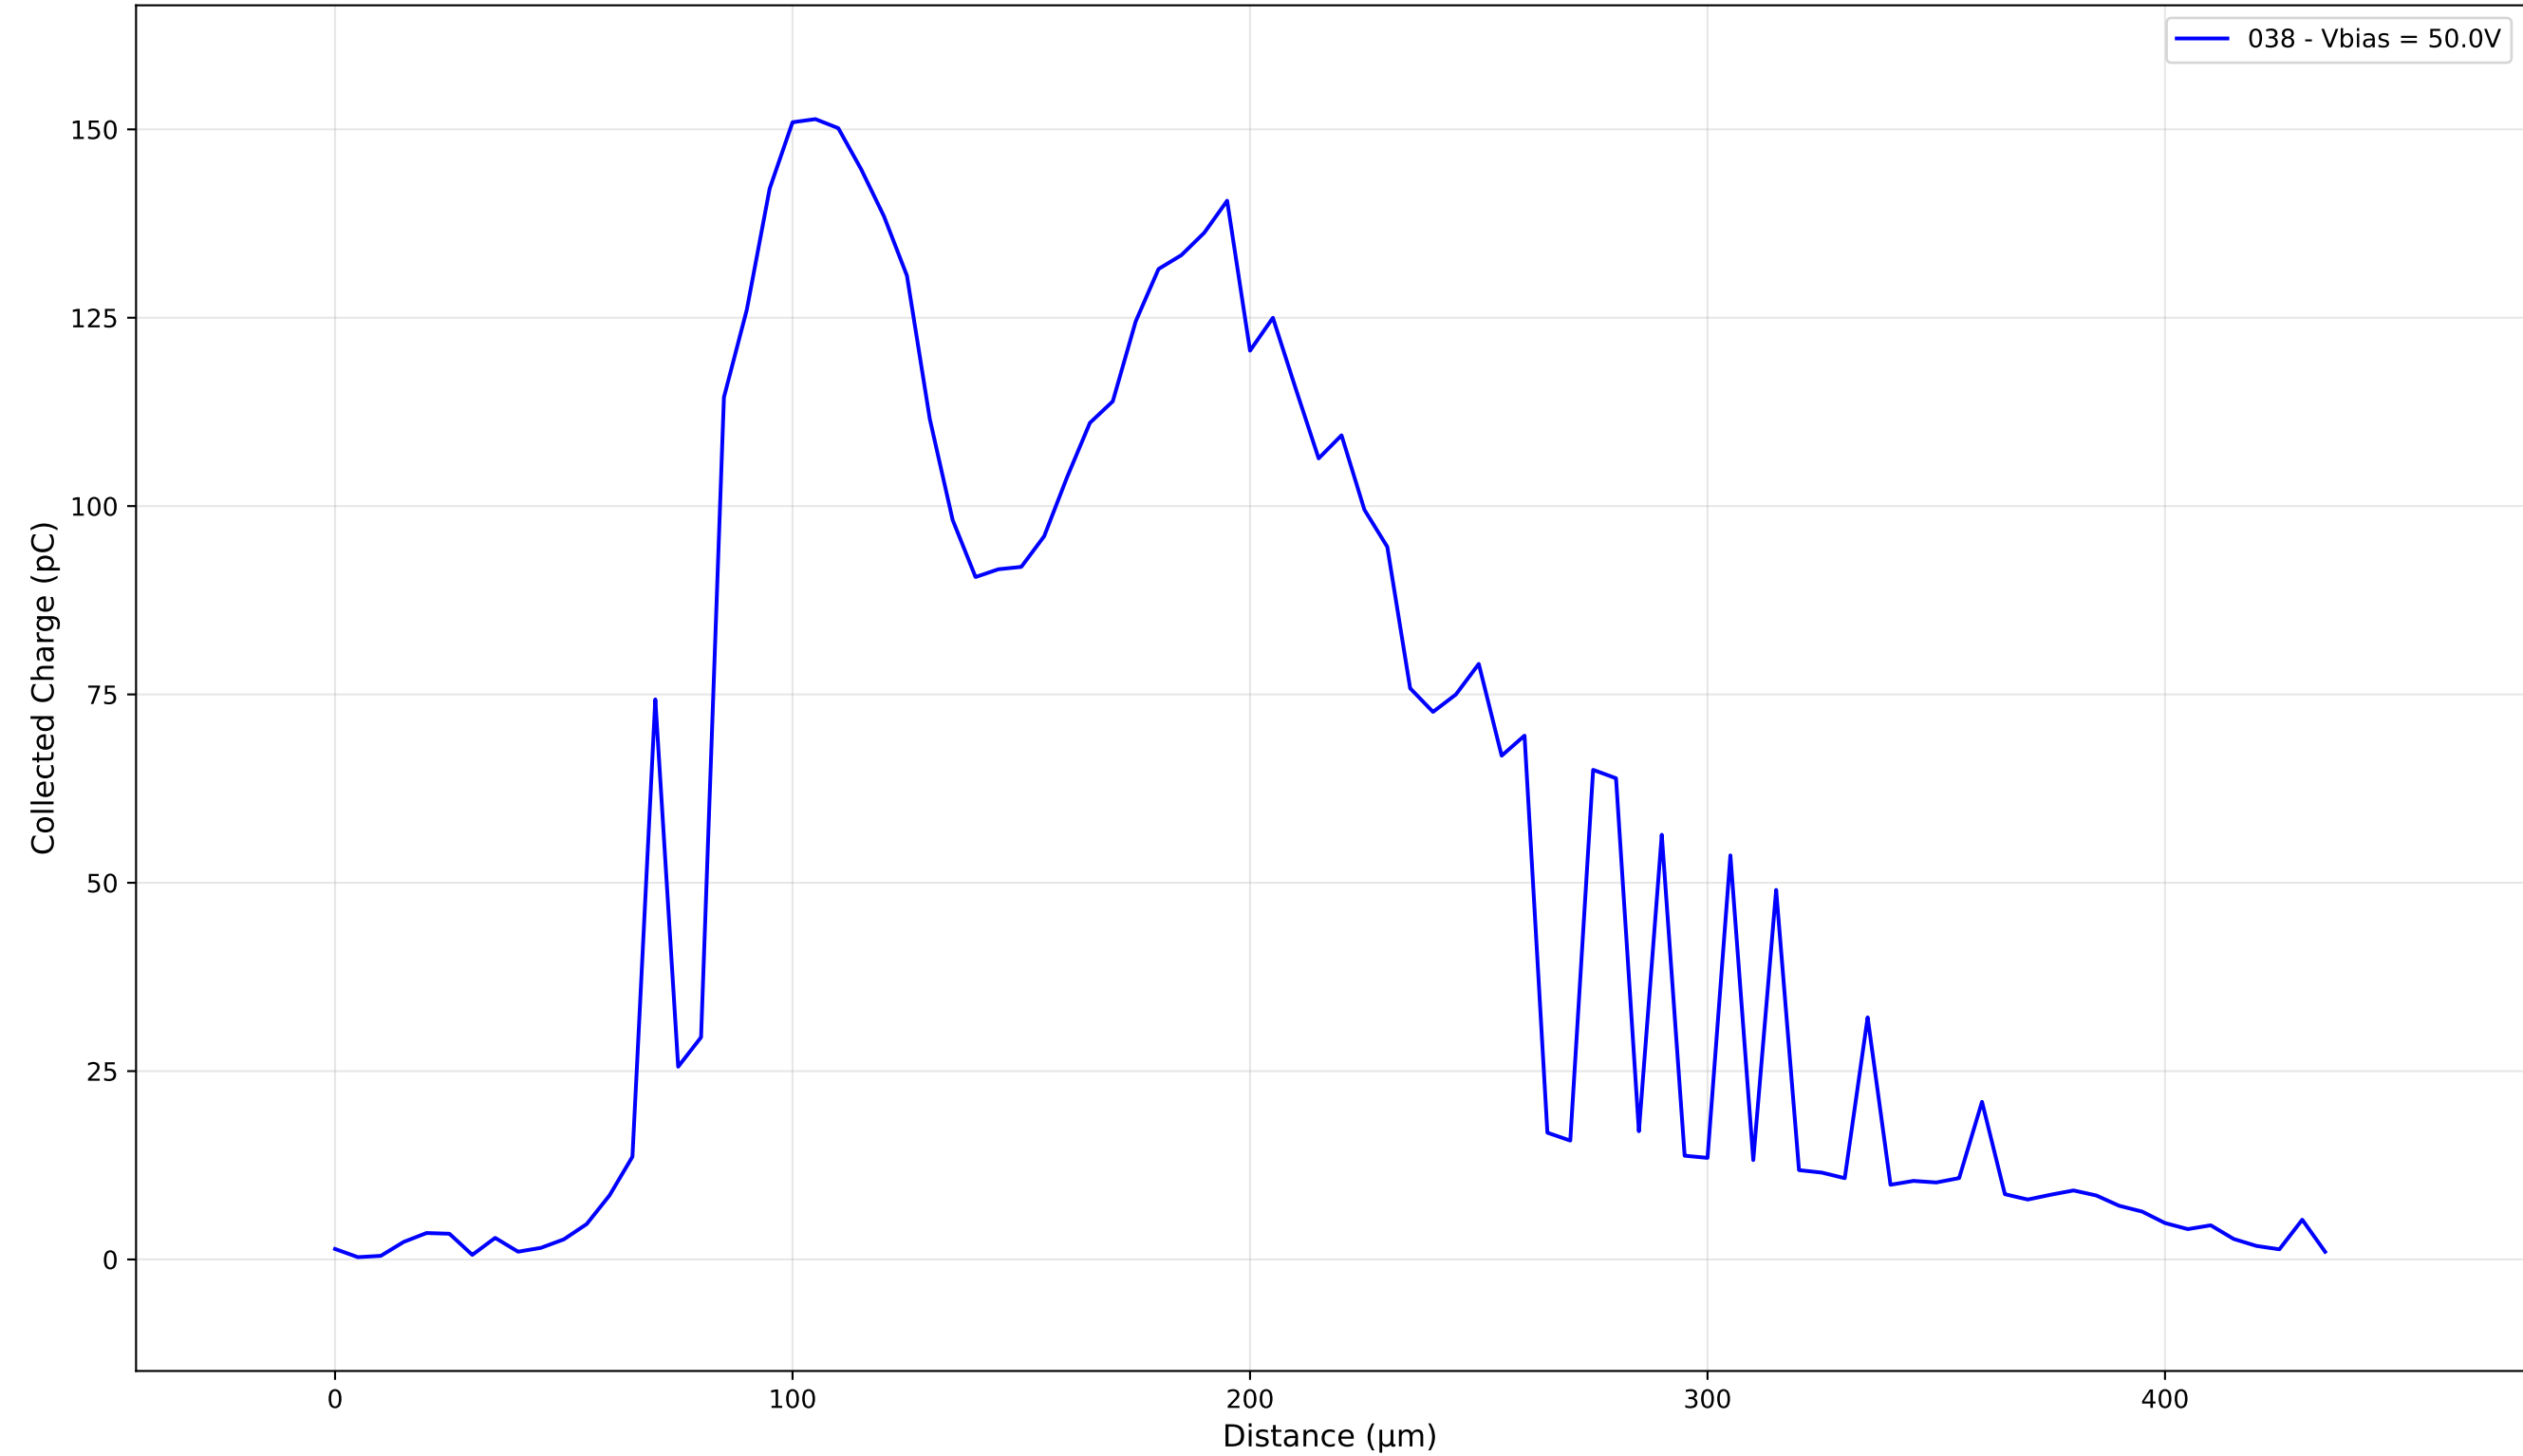

Collected Charge

038 - Vbias = 50.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

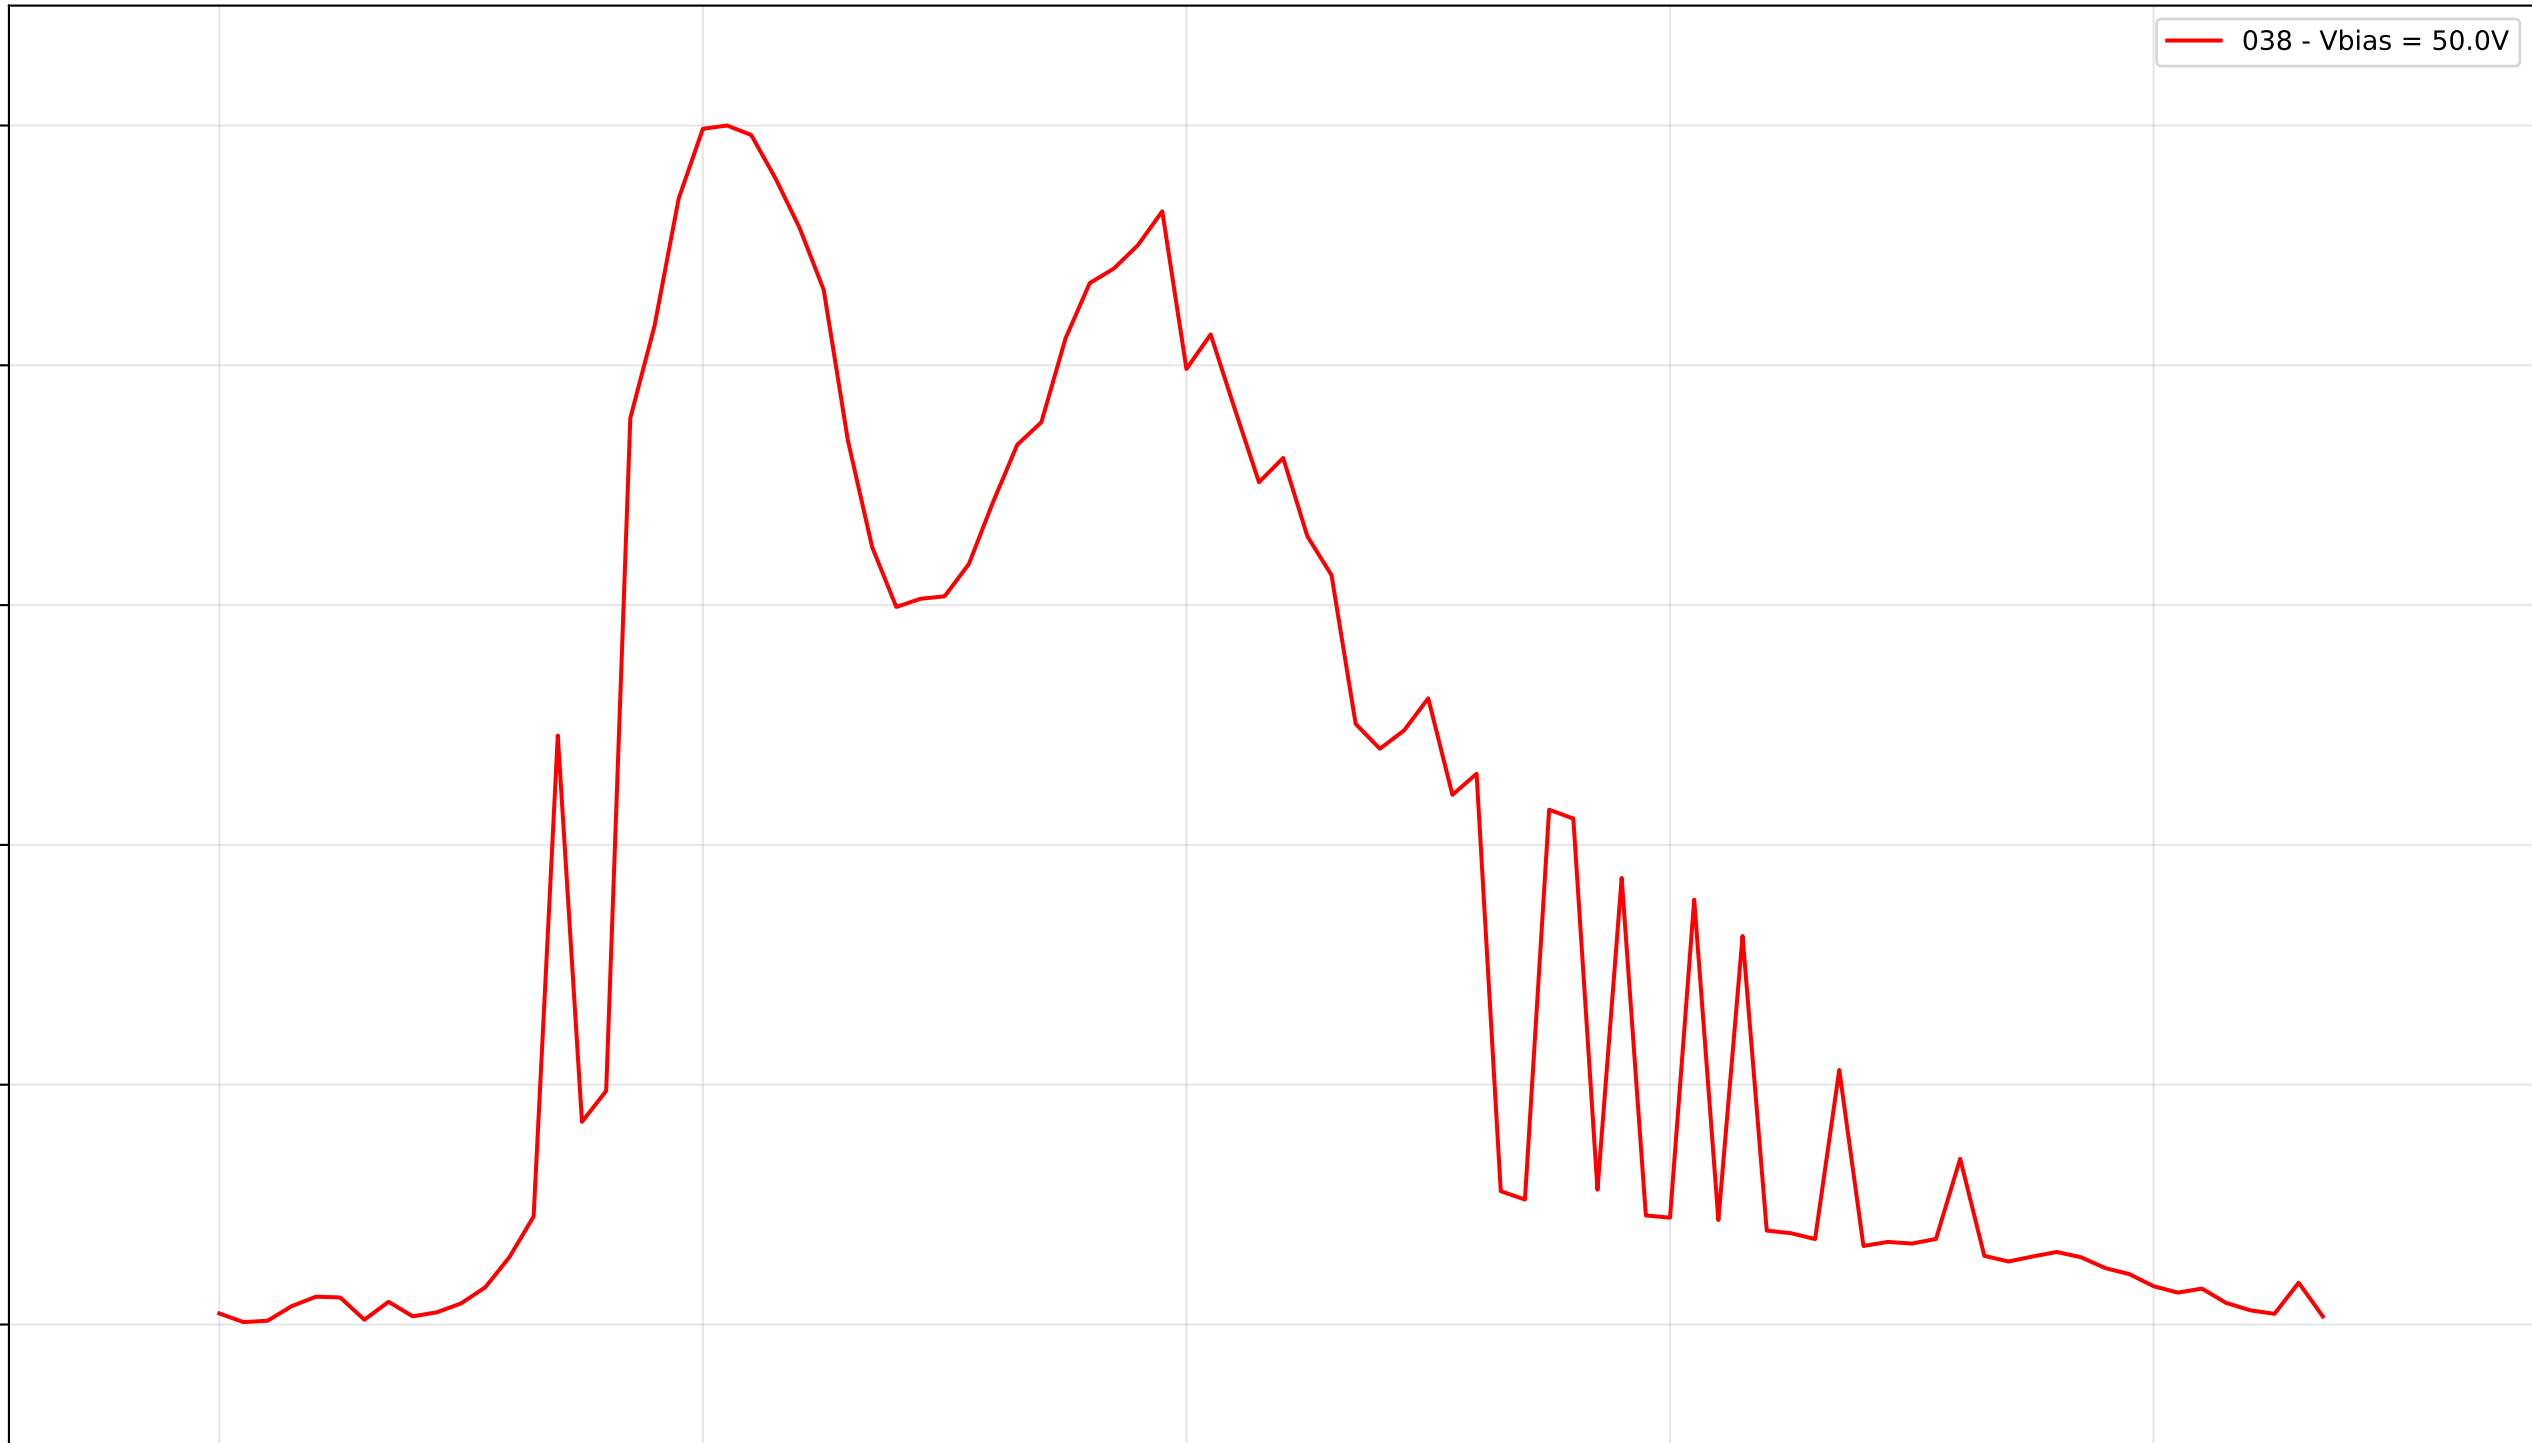


Rise Time

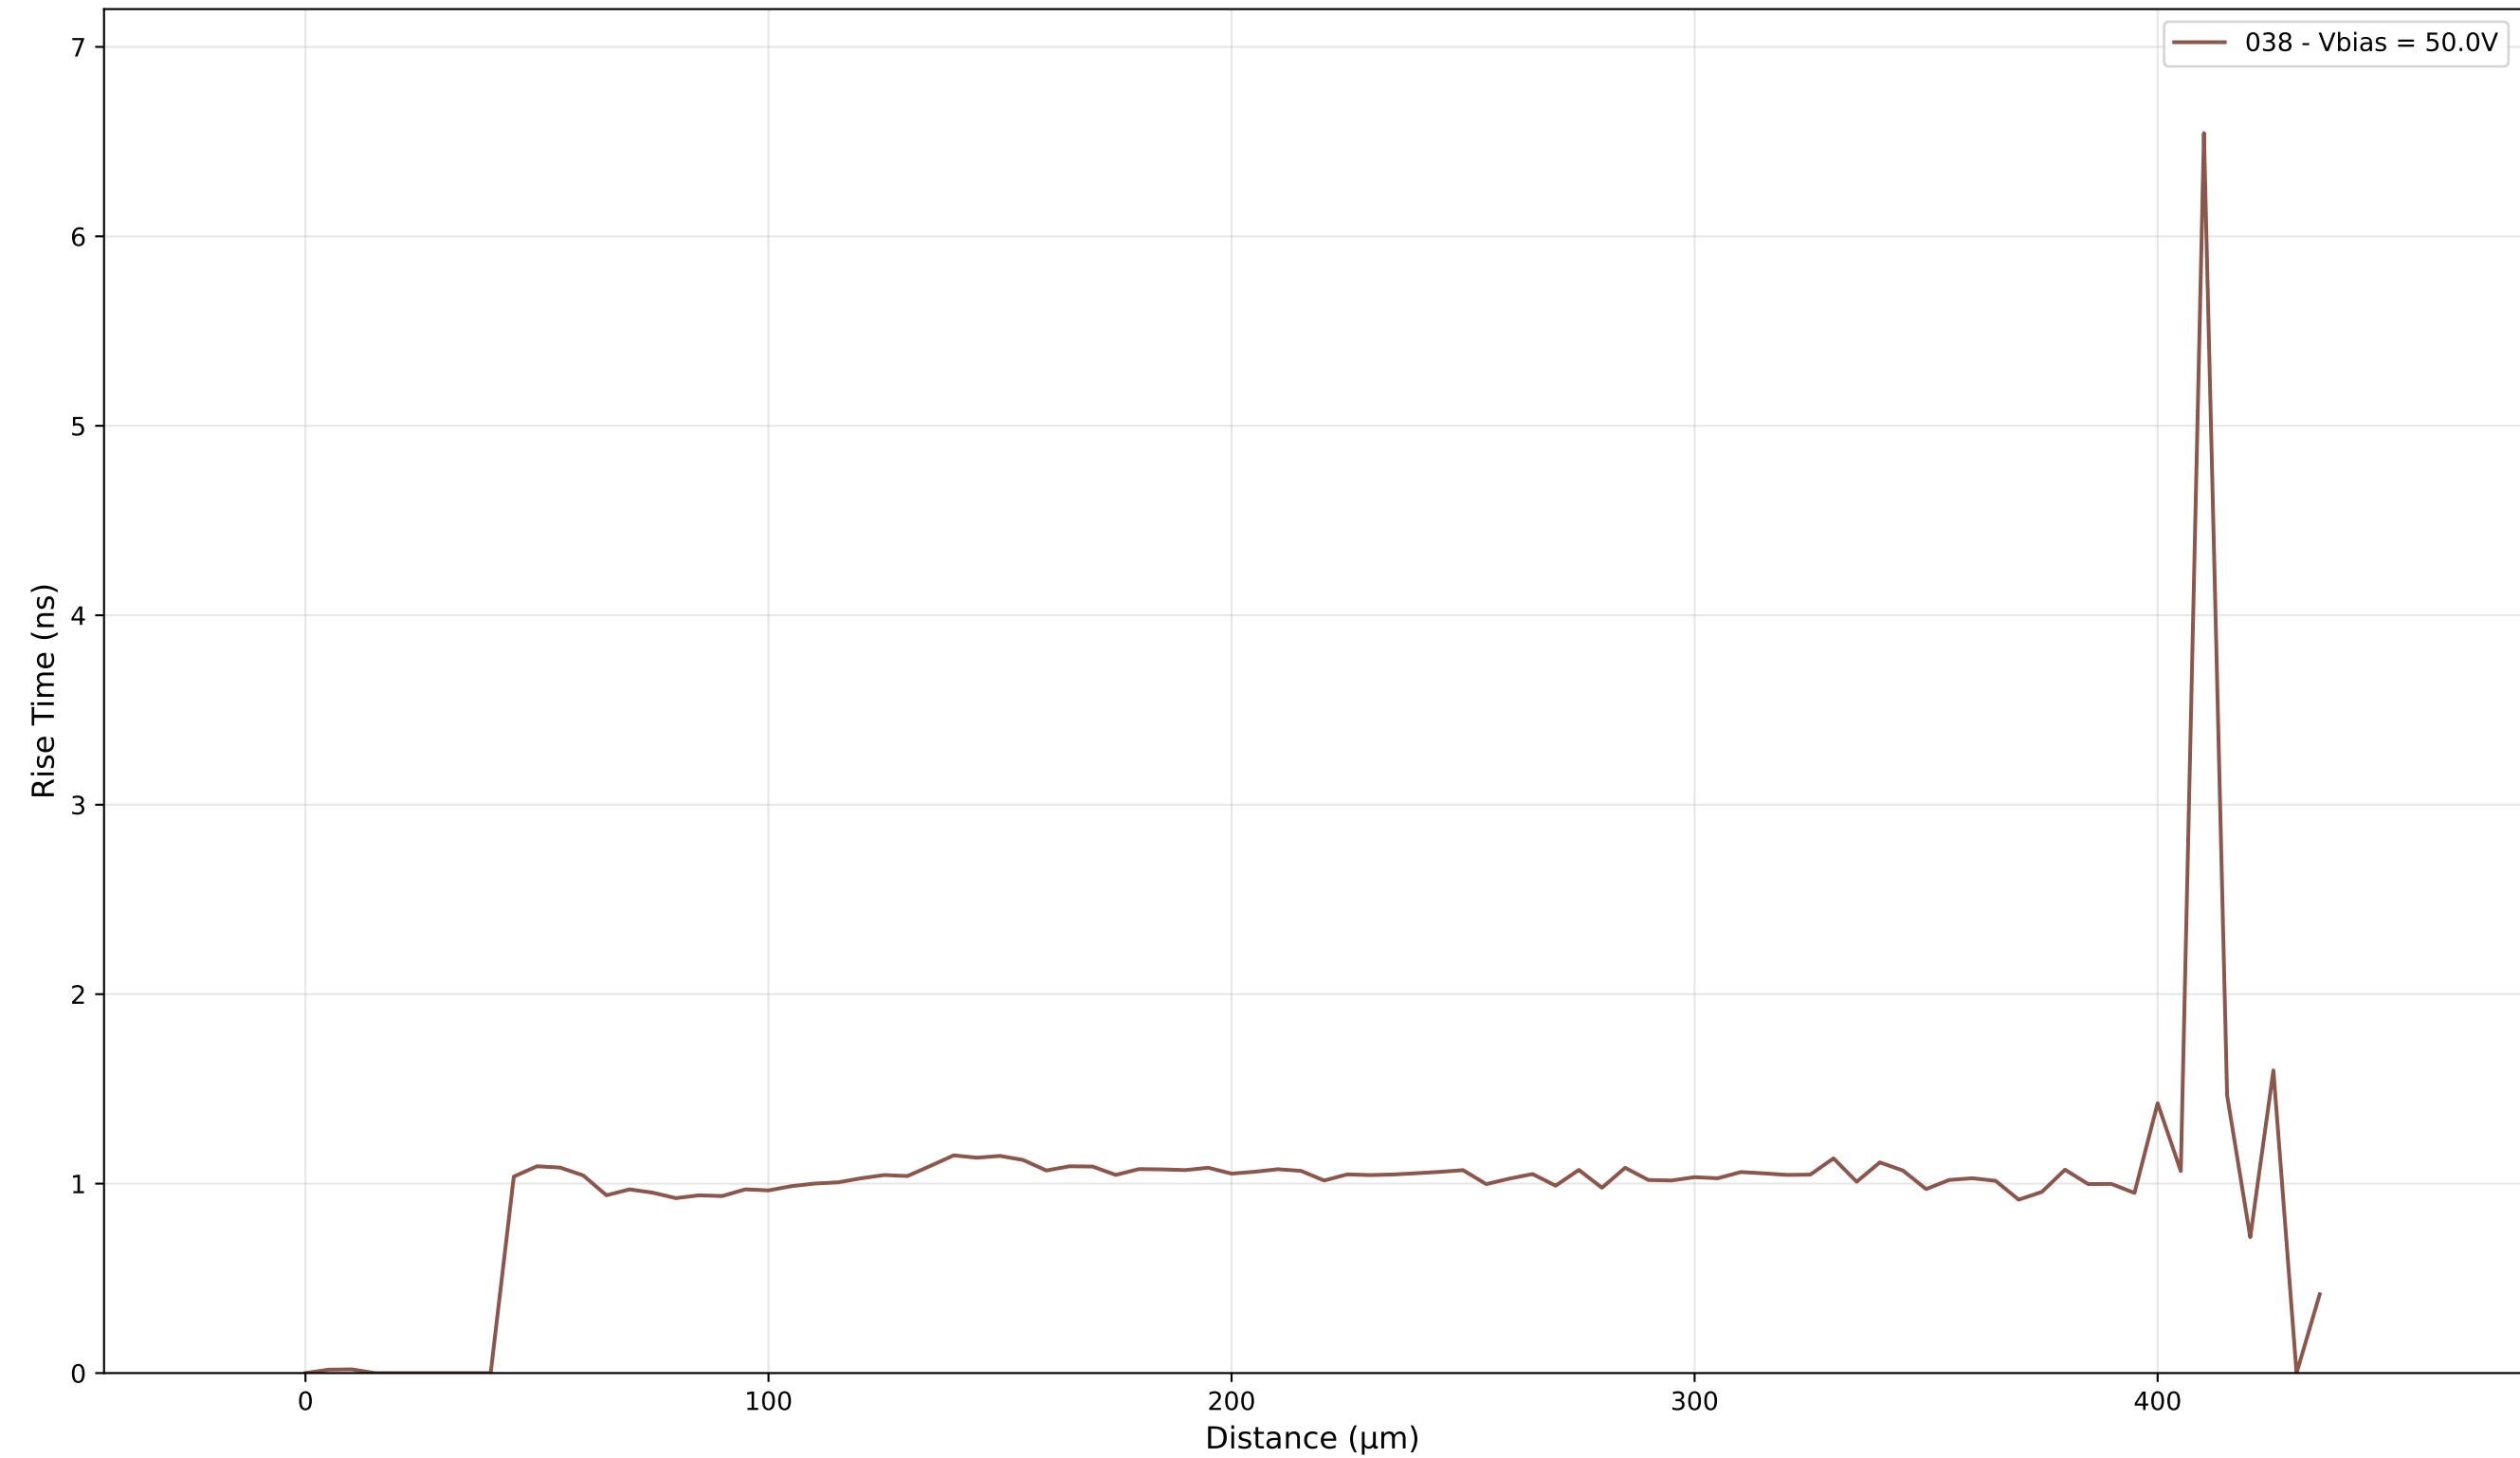


Amplitude

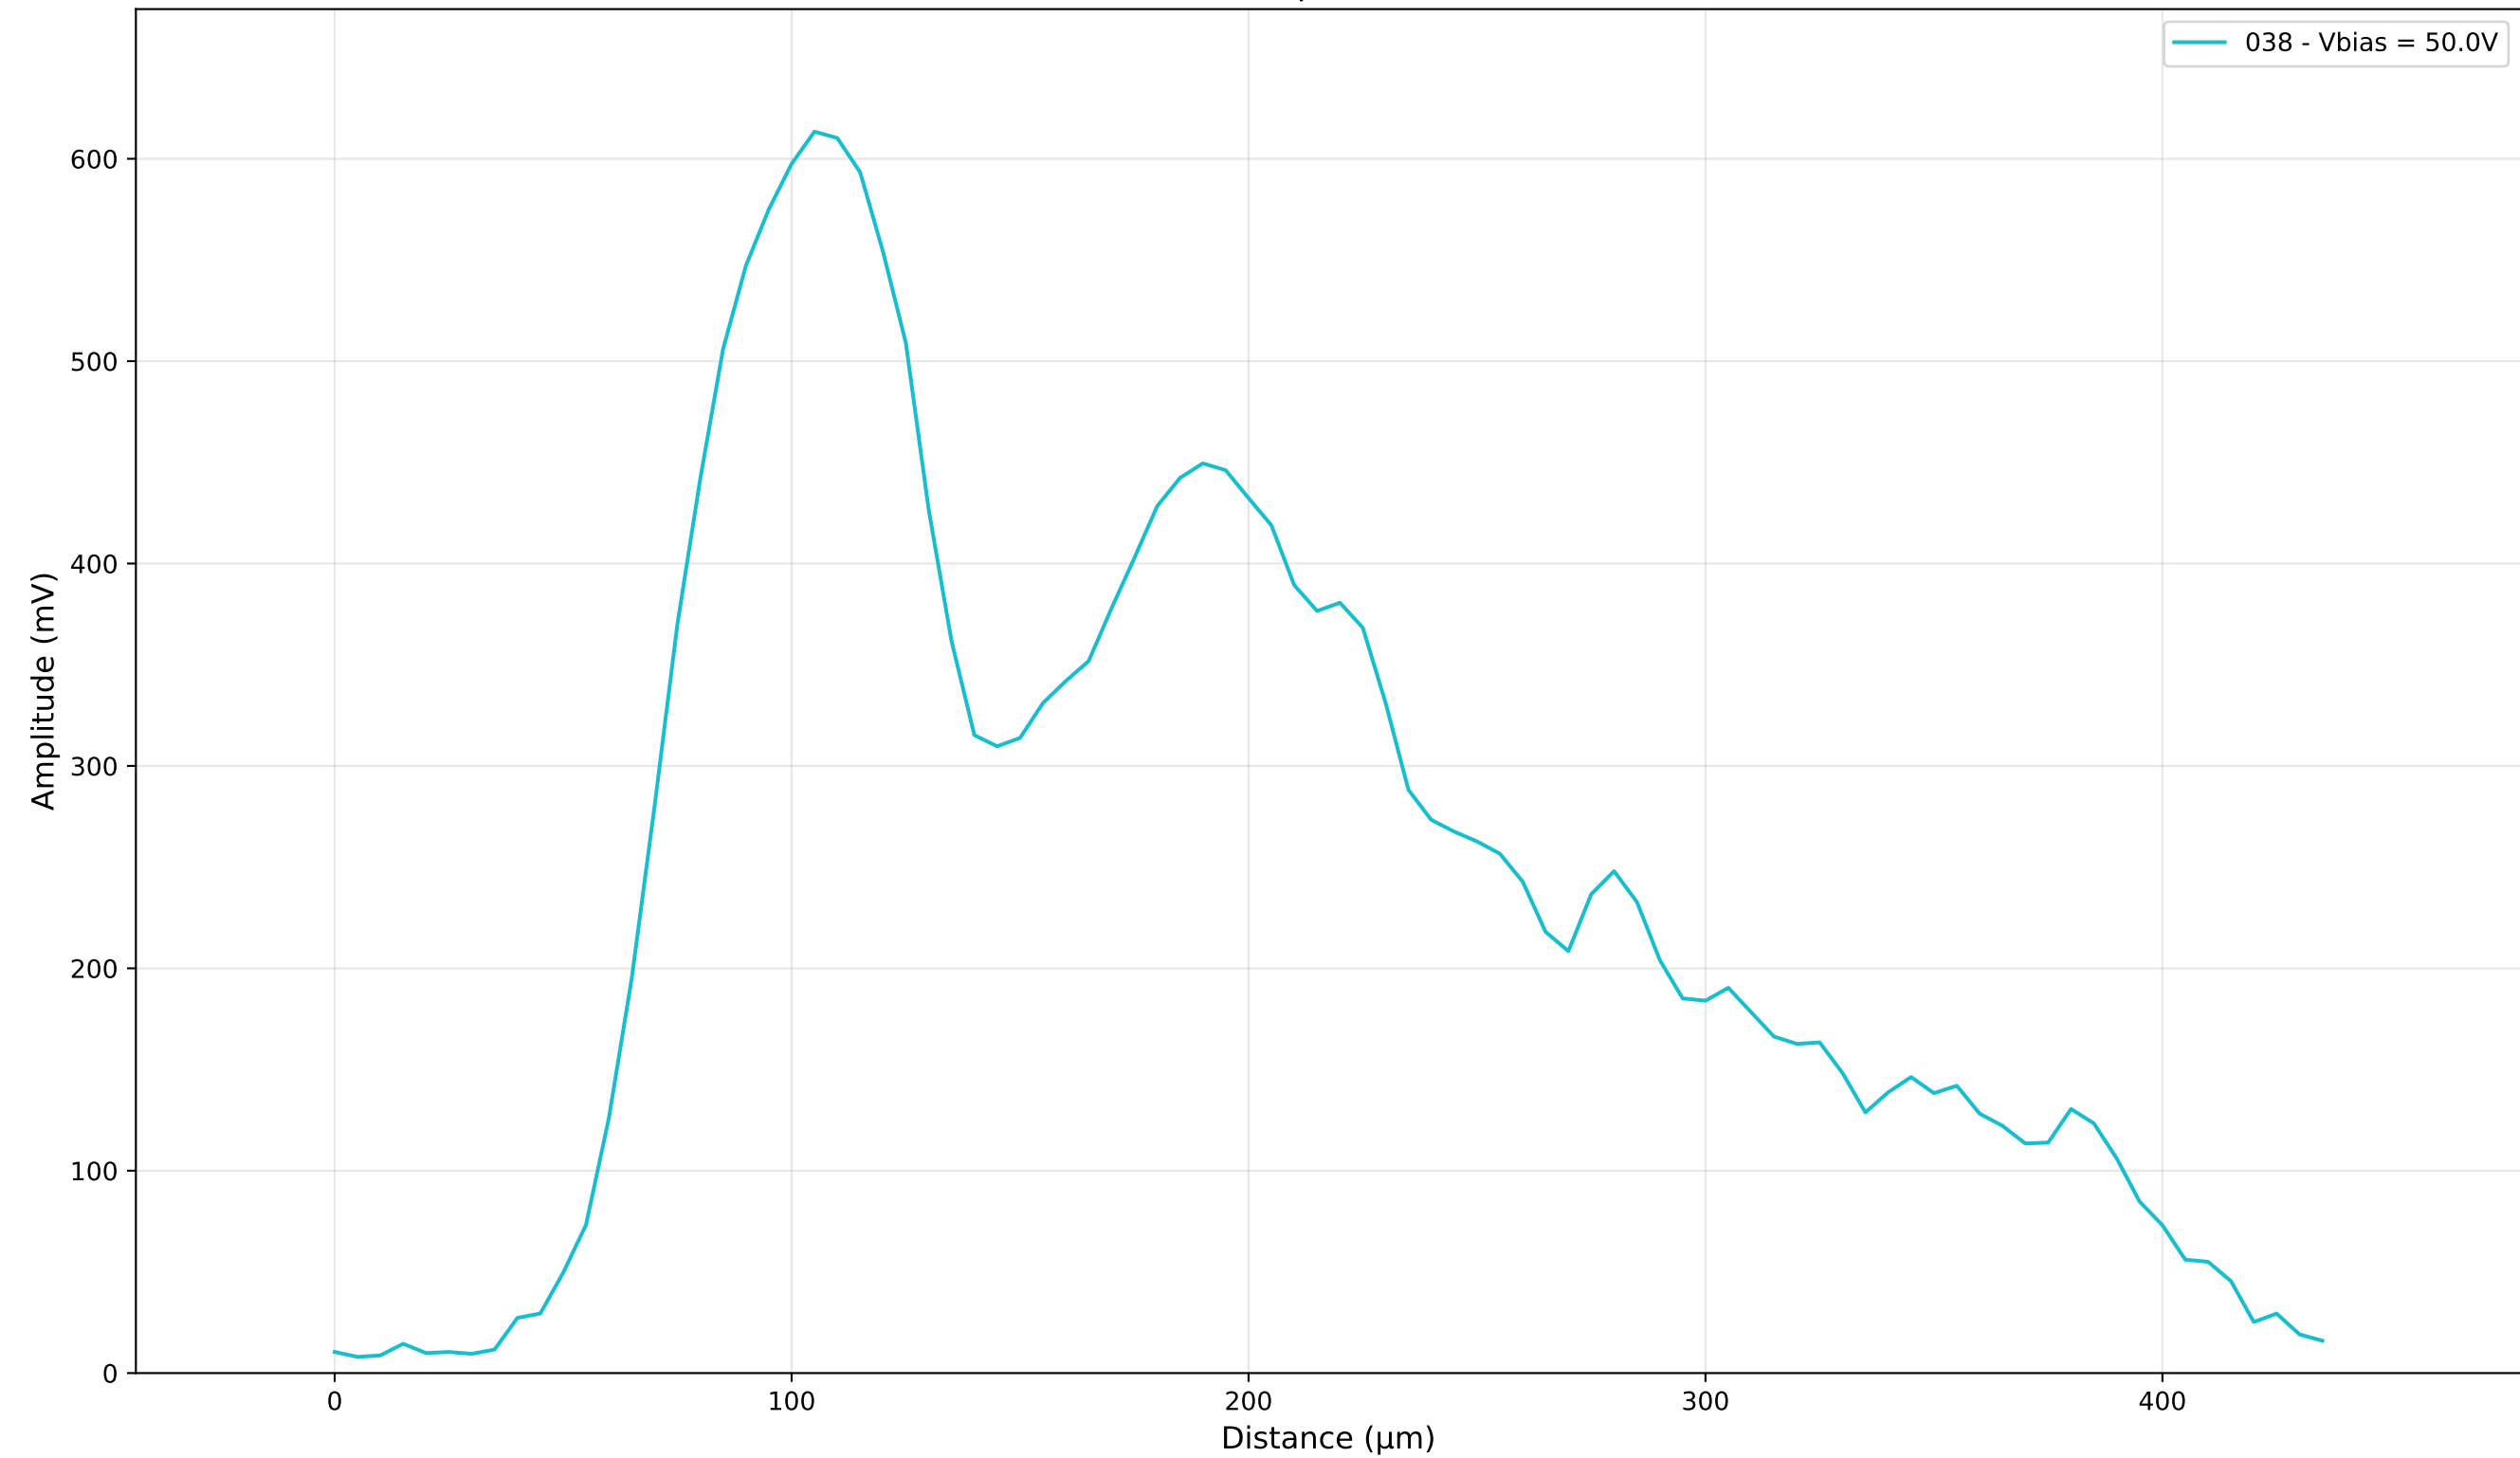


FWHM

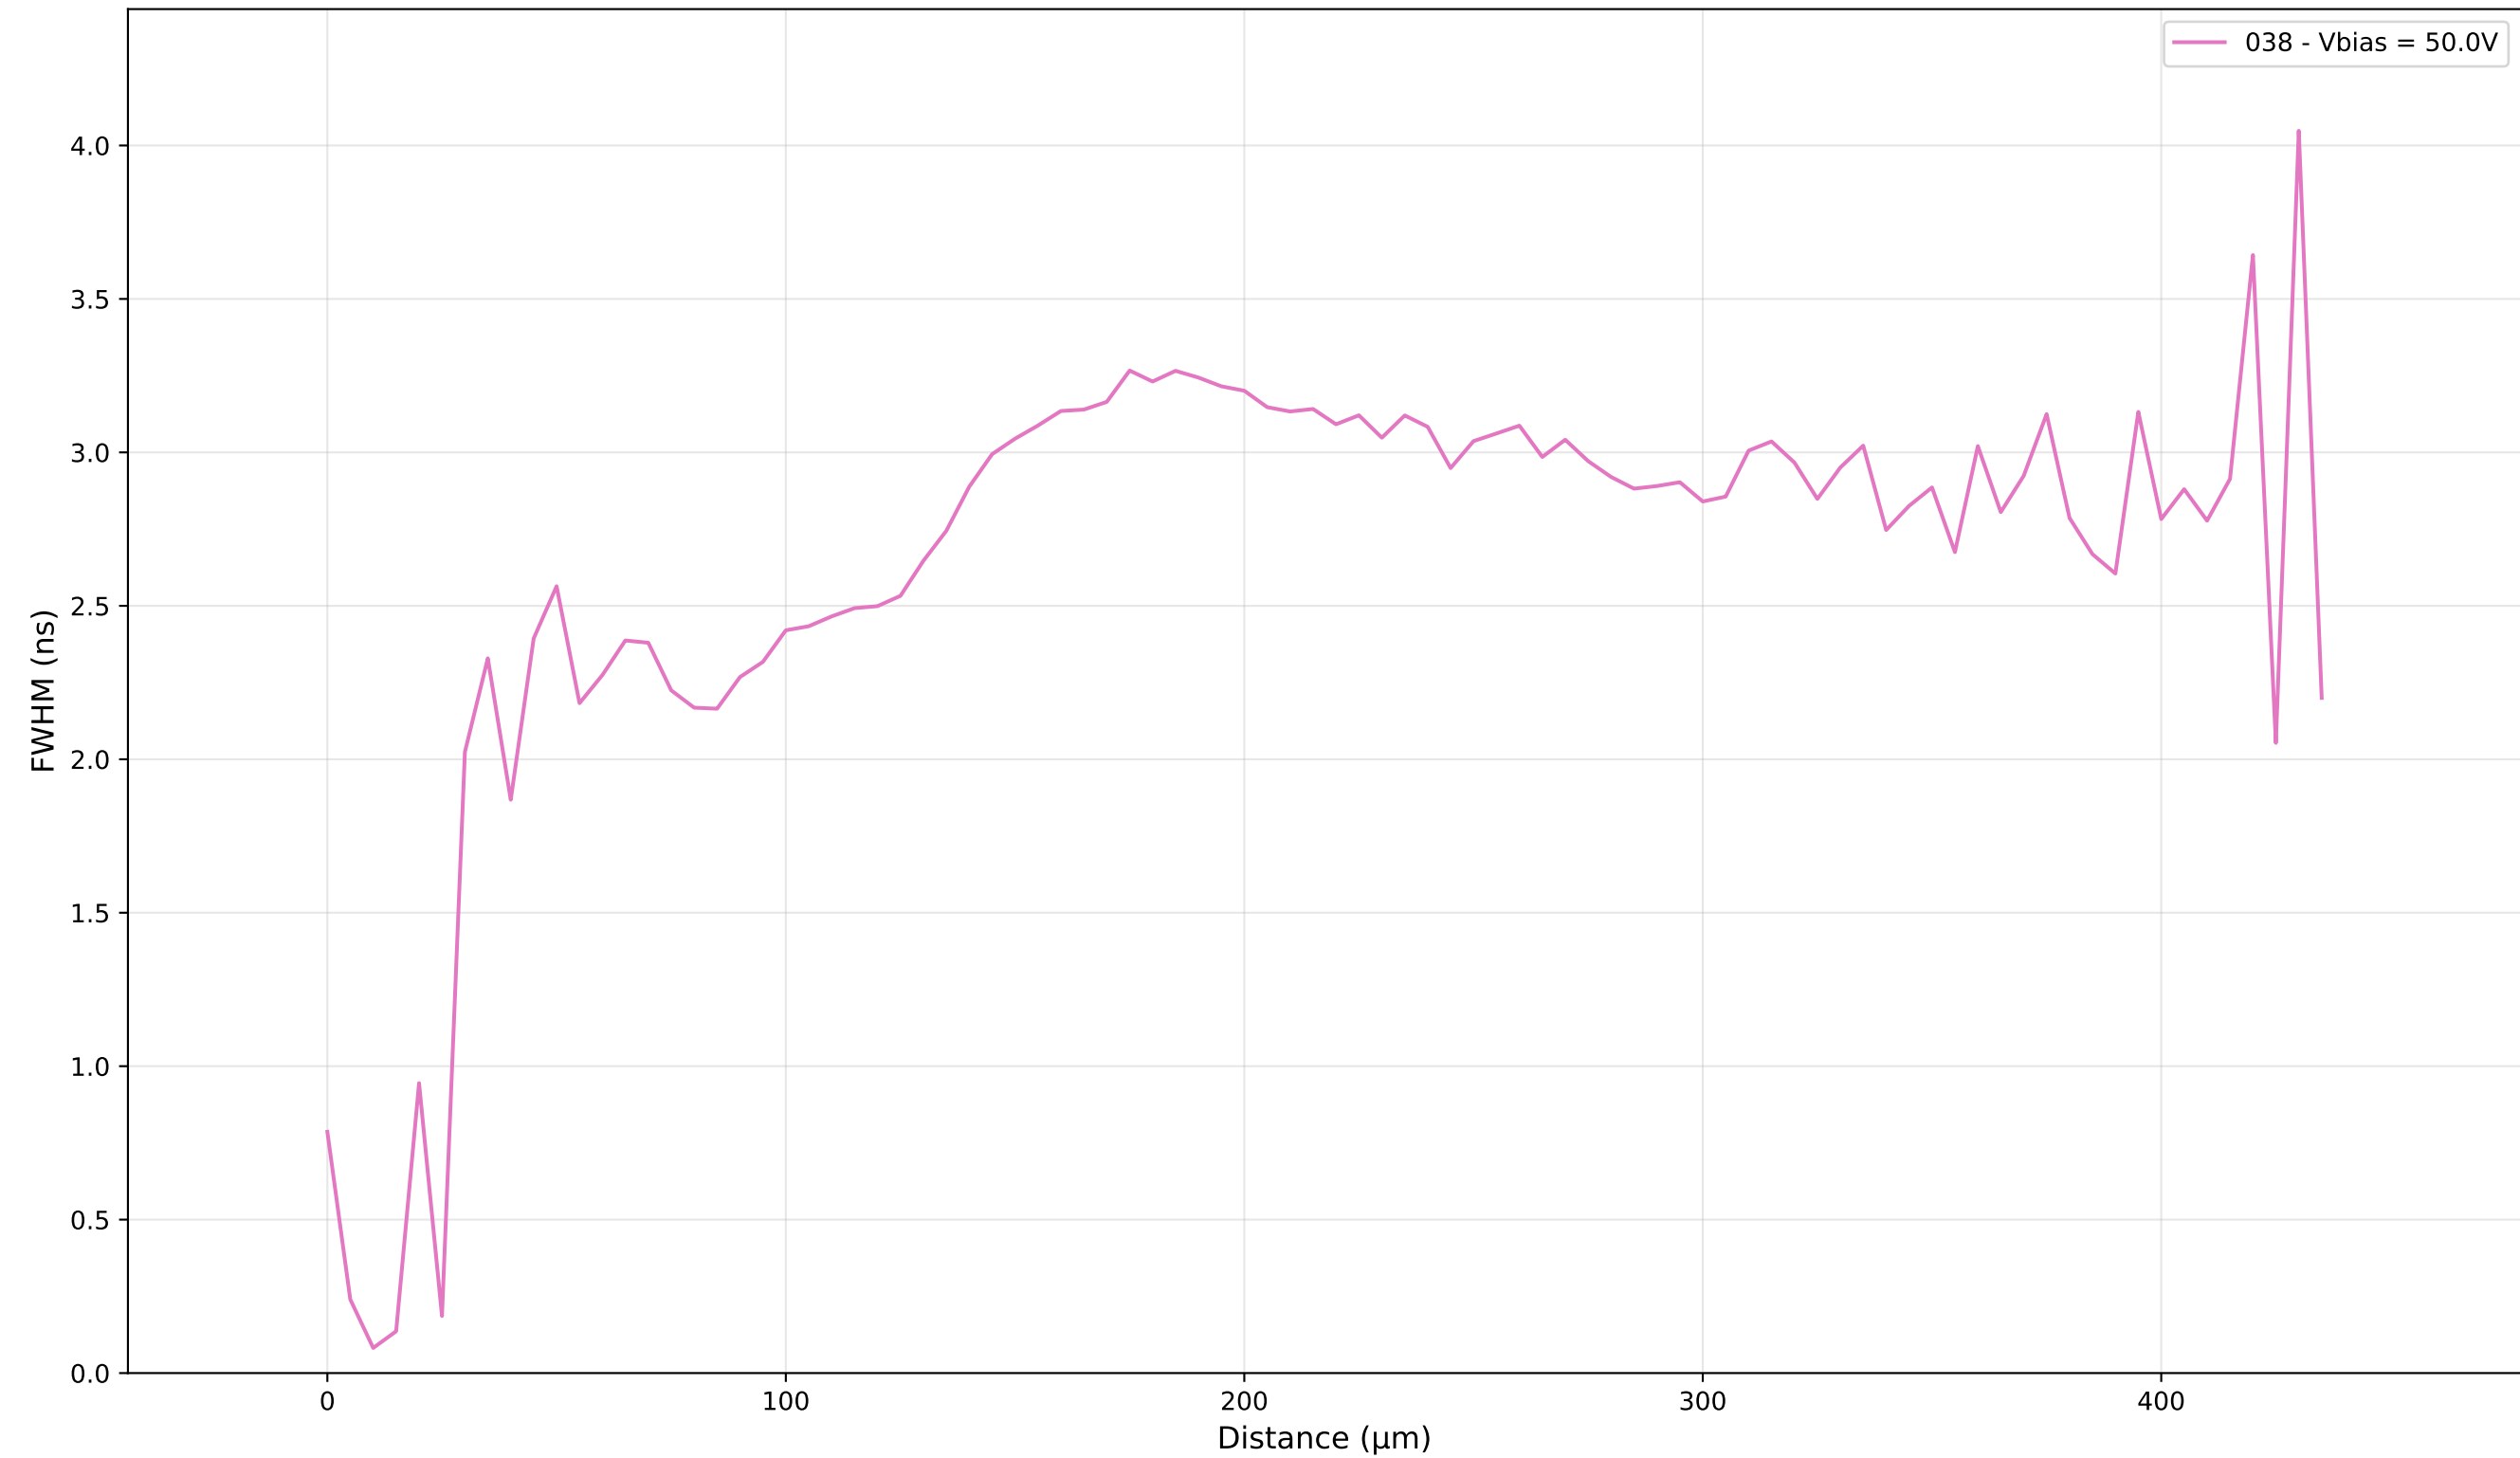


Transient Pulse - Sample: TD_4004 - Position: 0.0 μm - Charge: 1.39 pC - Rise Time: 0.00 ns (N/A)

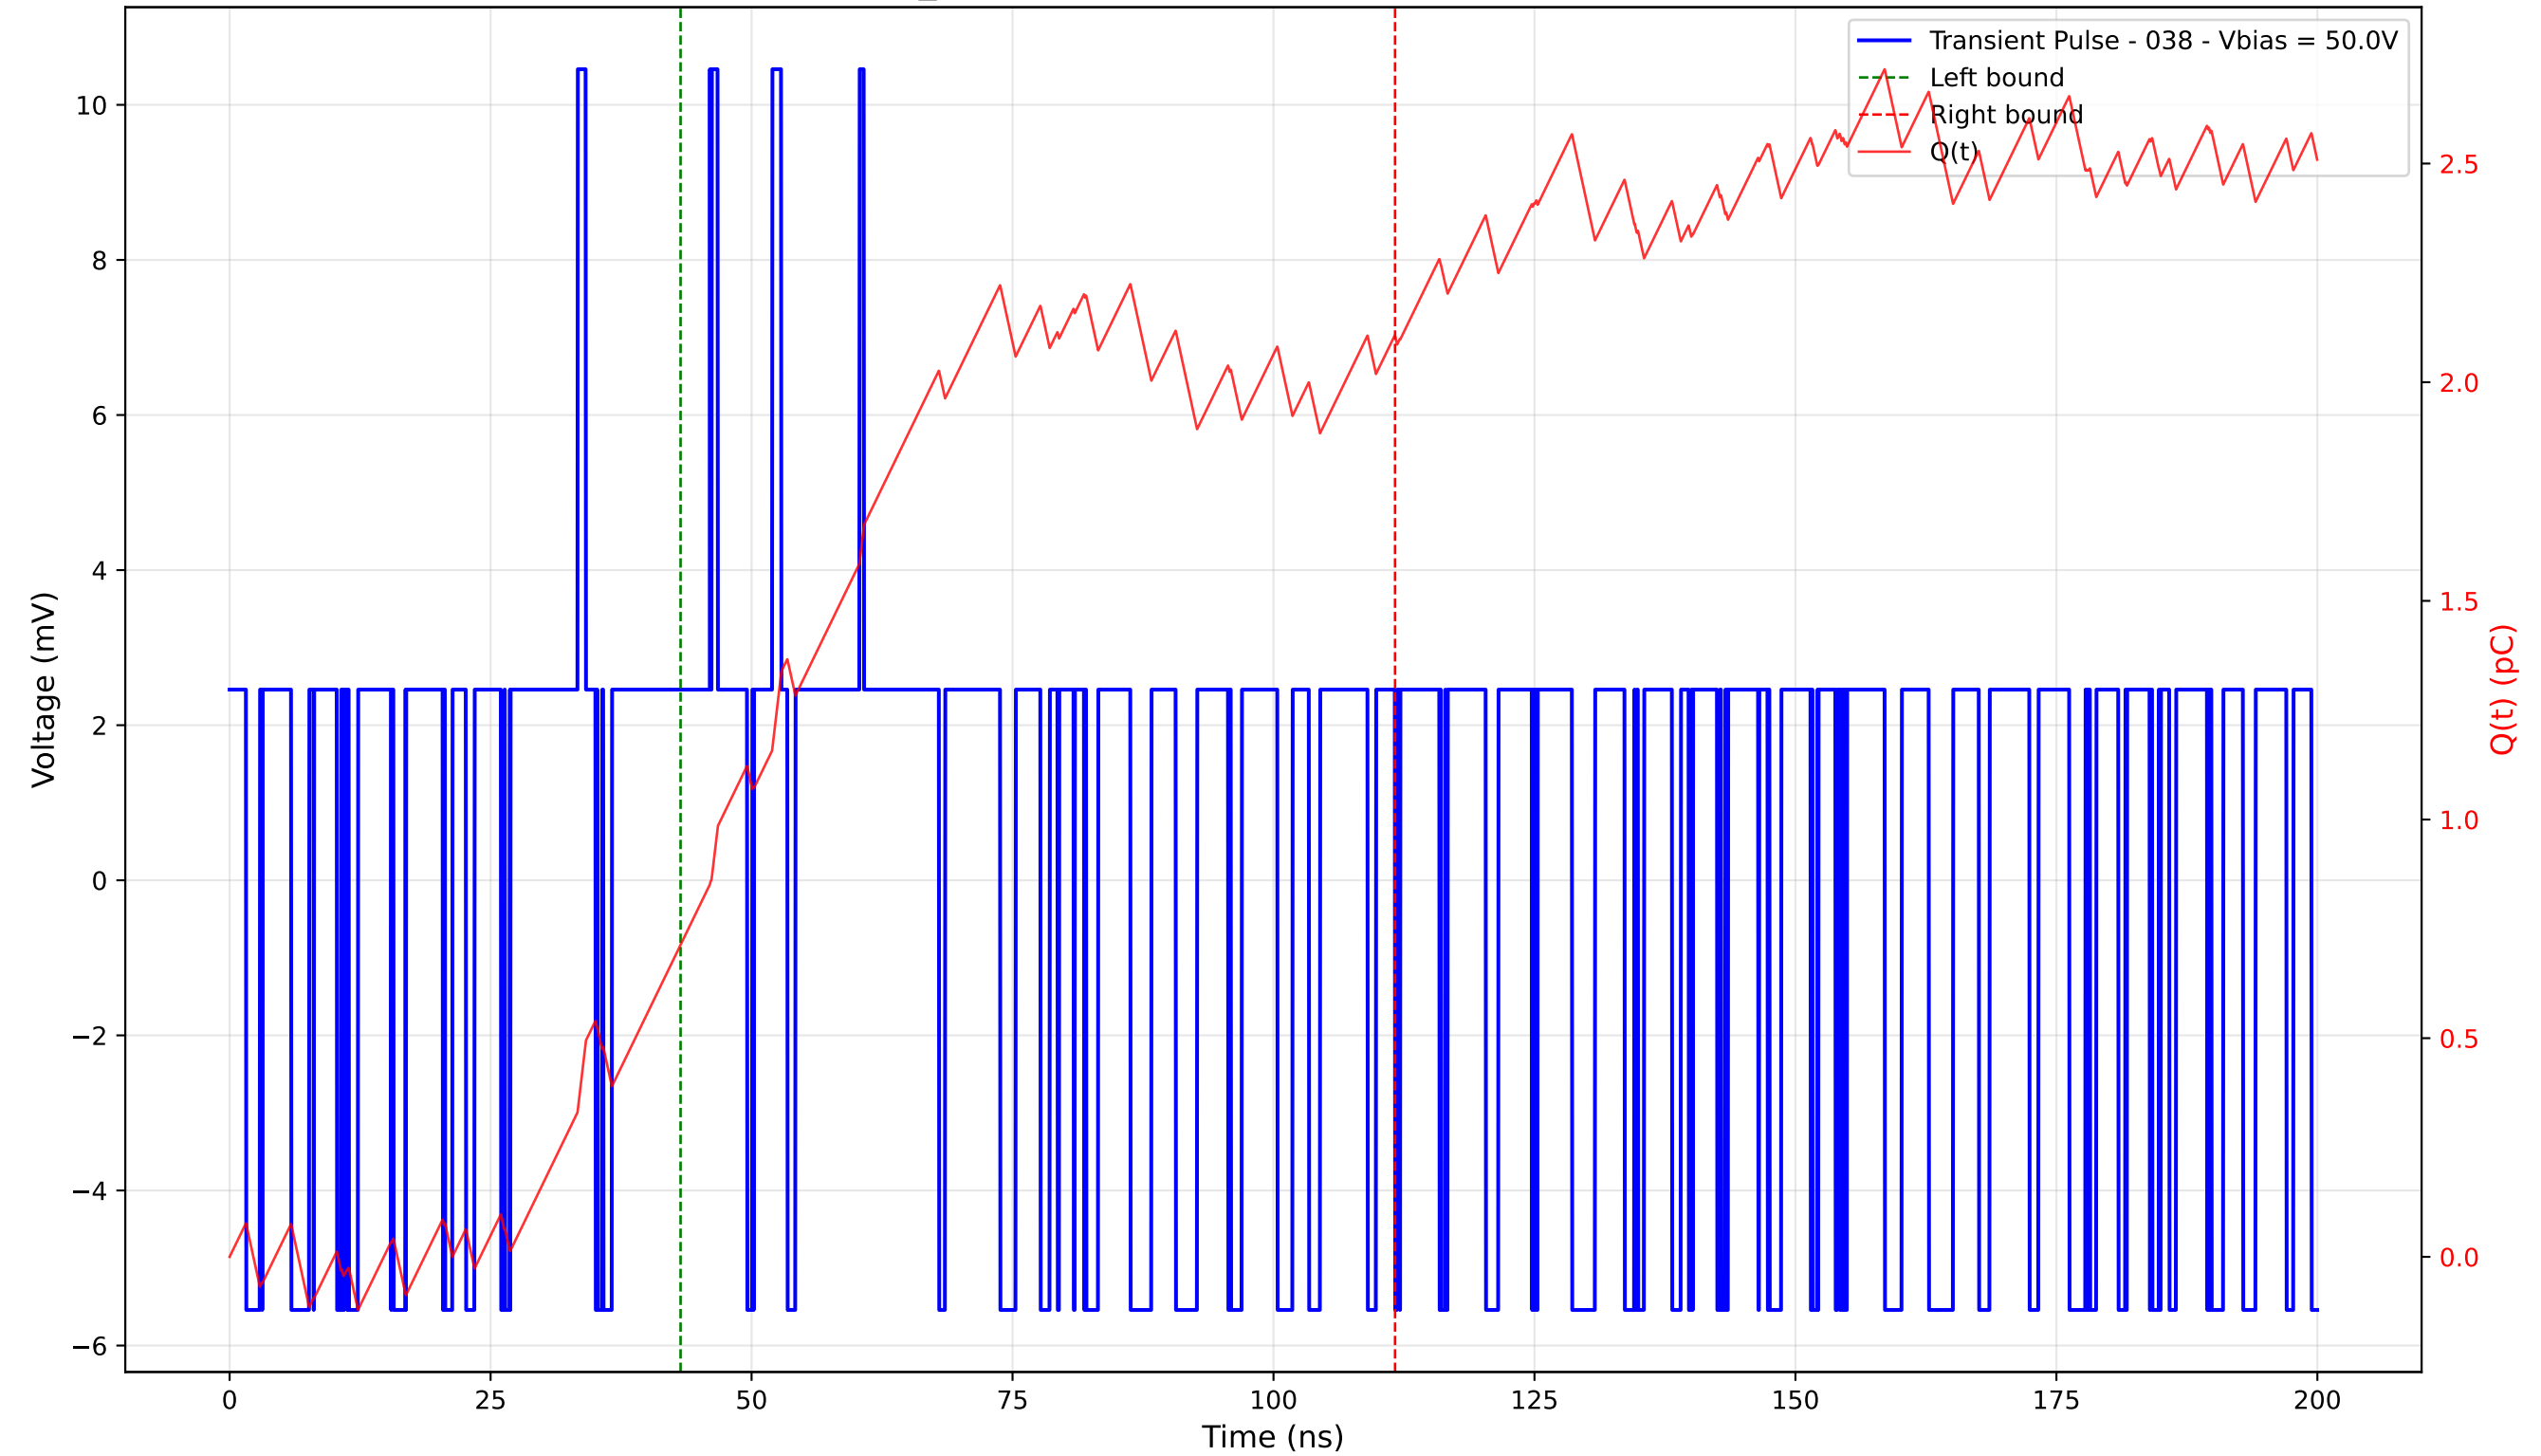


Transient Pulse - Sample: TD_4004 - Position: 5.0 μm - Charge: 0.30 pC - Rise Time: 0.02 ns

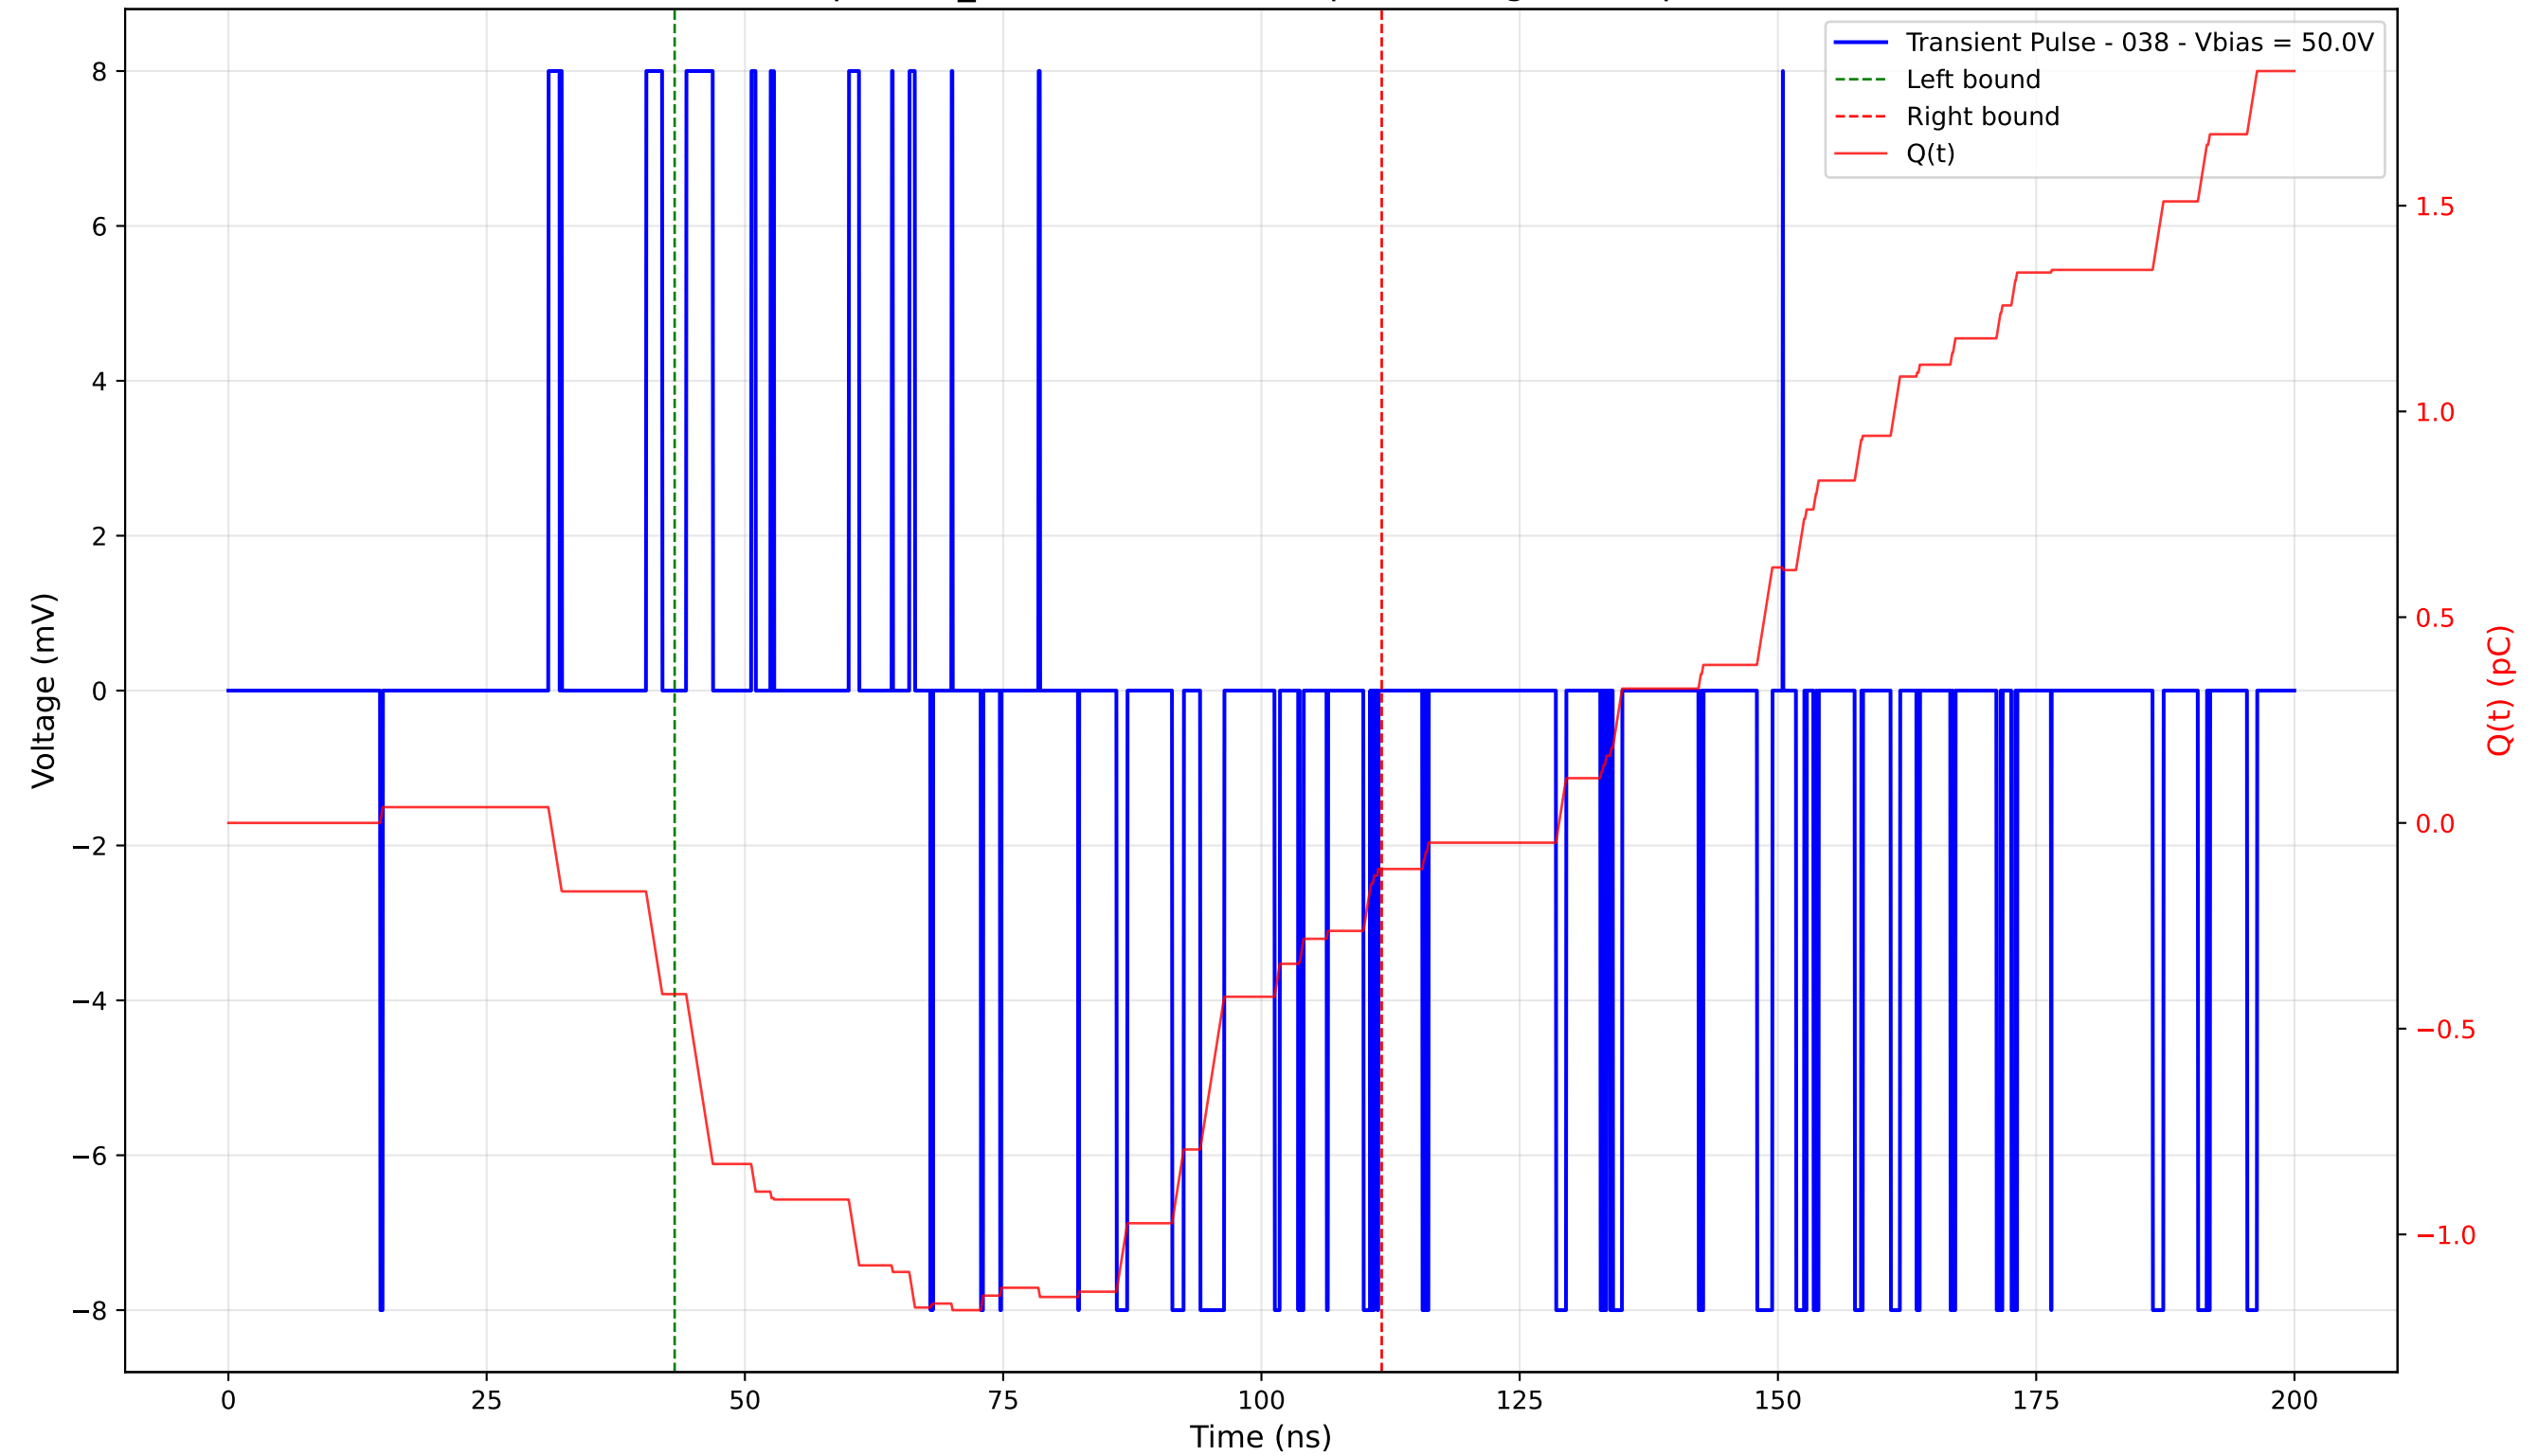


Transient Pulse - Sample: TD_4004 - Position: 10.0 μm - Charge: 0.48 pC - Rise Time: 0.02 ns

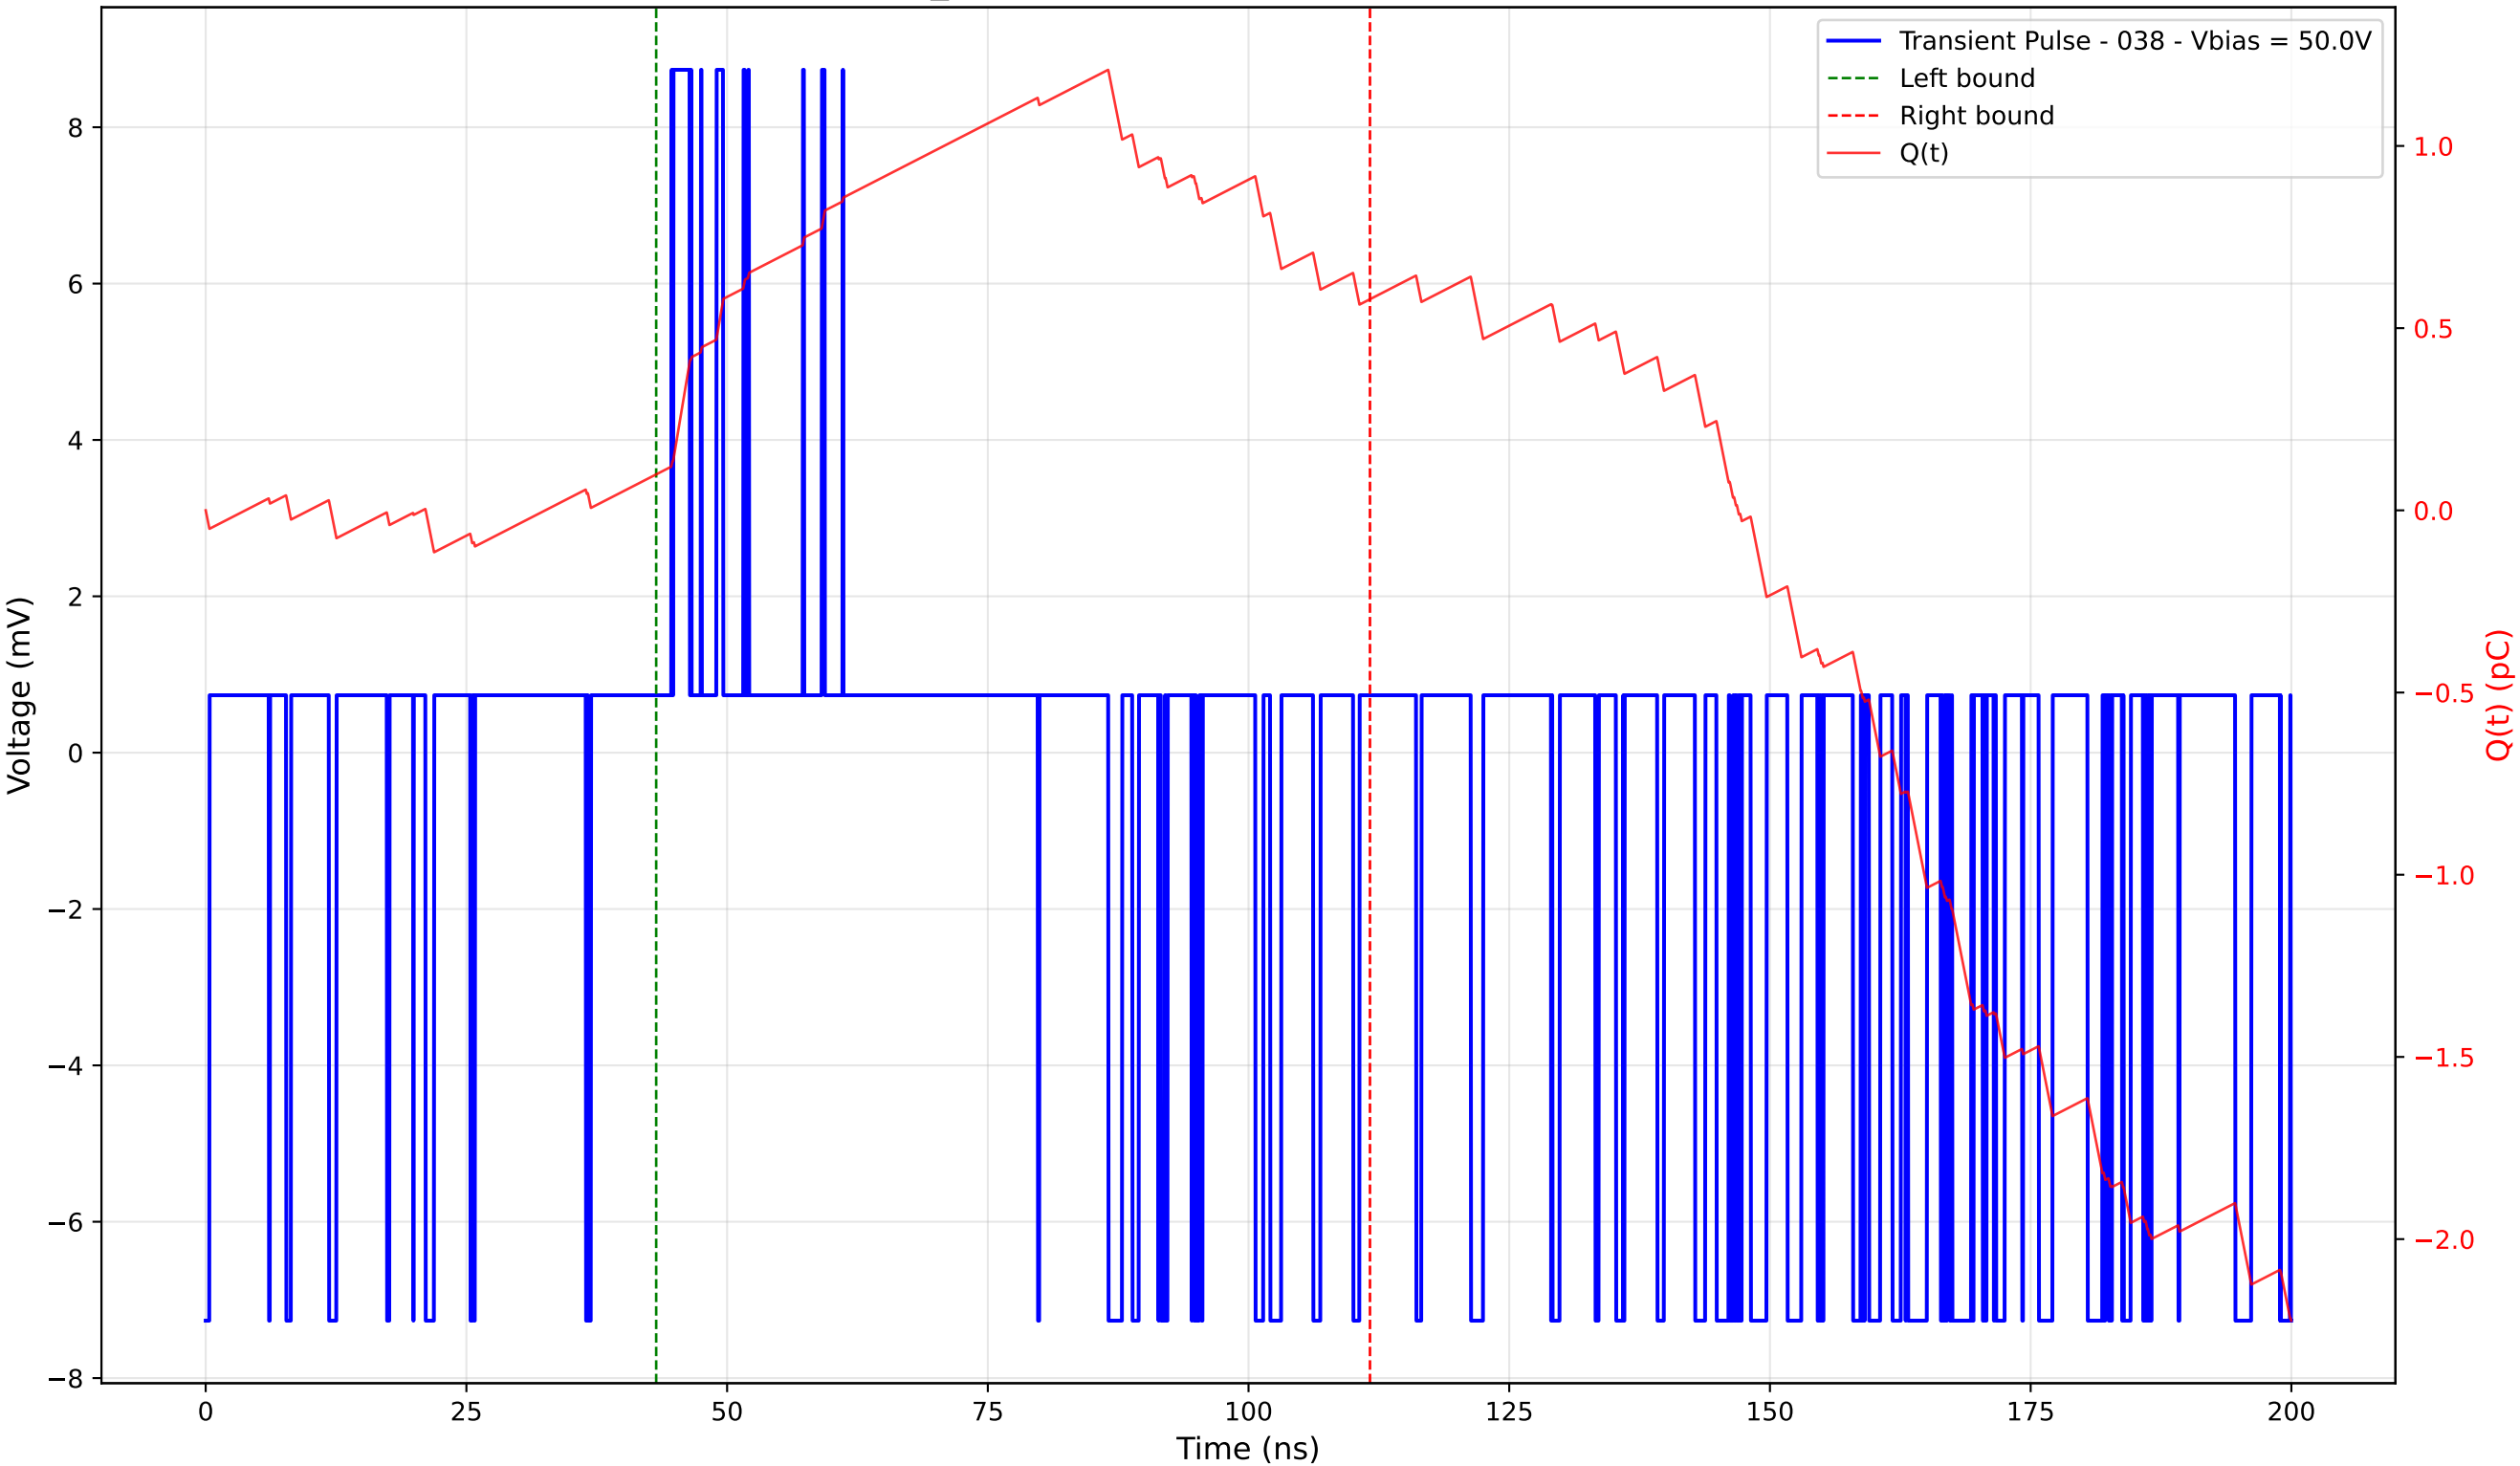


Transient Pulse - Sample: TD_4004 - Position: 15.0 μm - Charge: 2.33 pC - Rise Time: 0.00 ns (N/A)

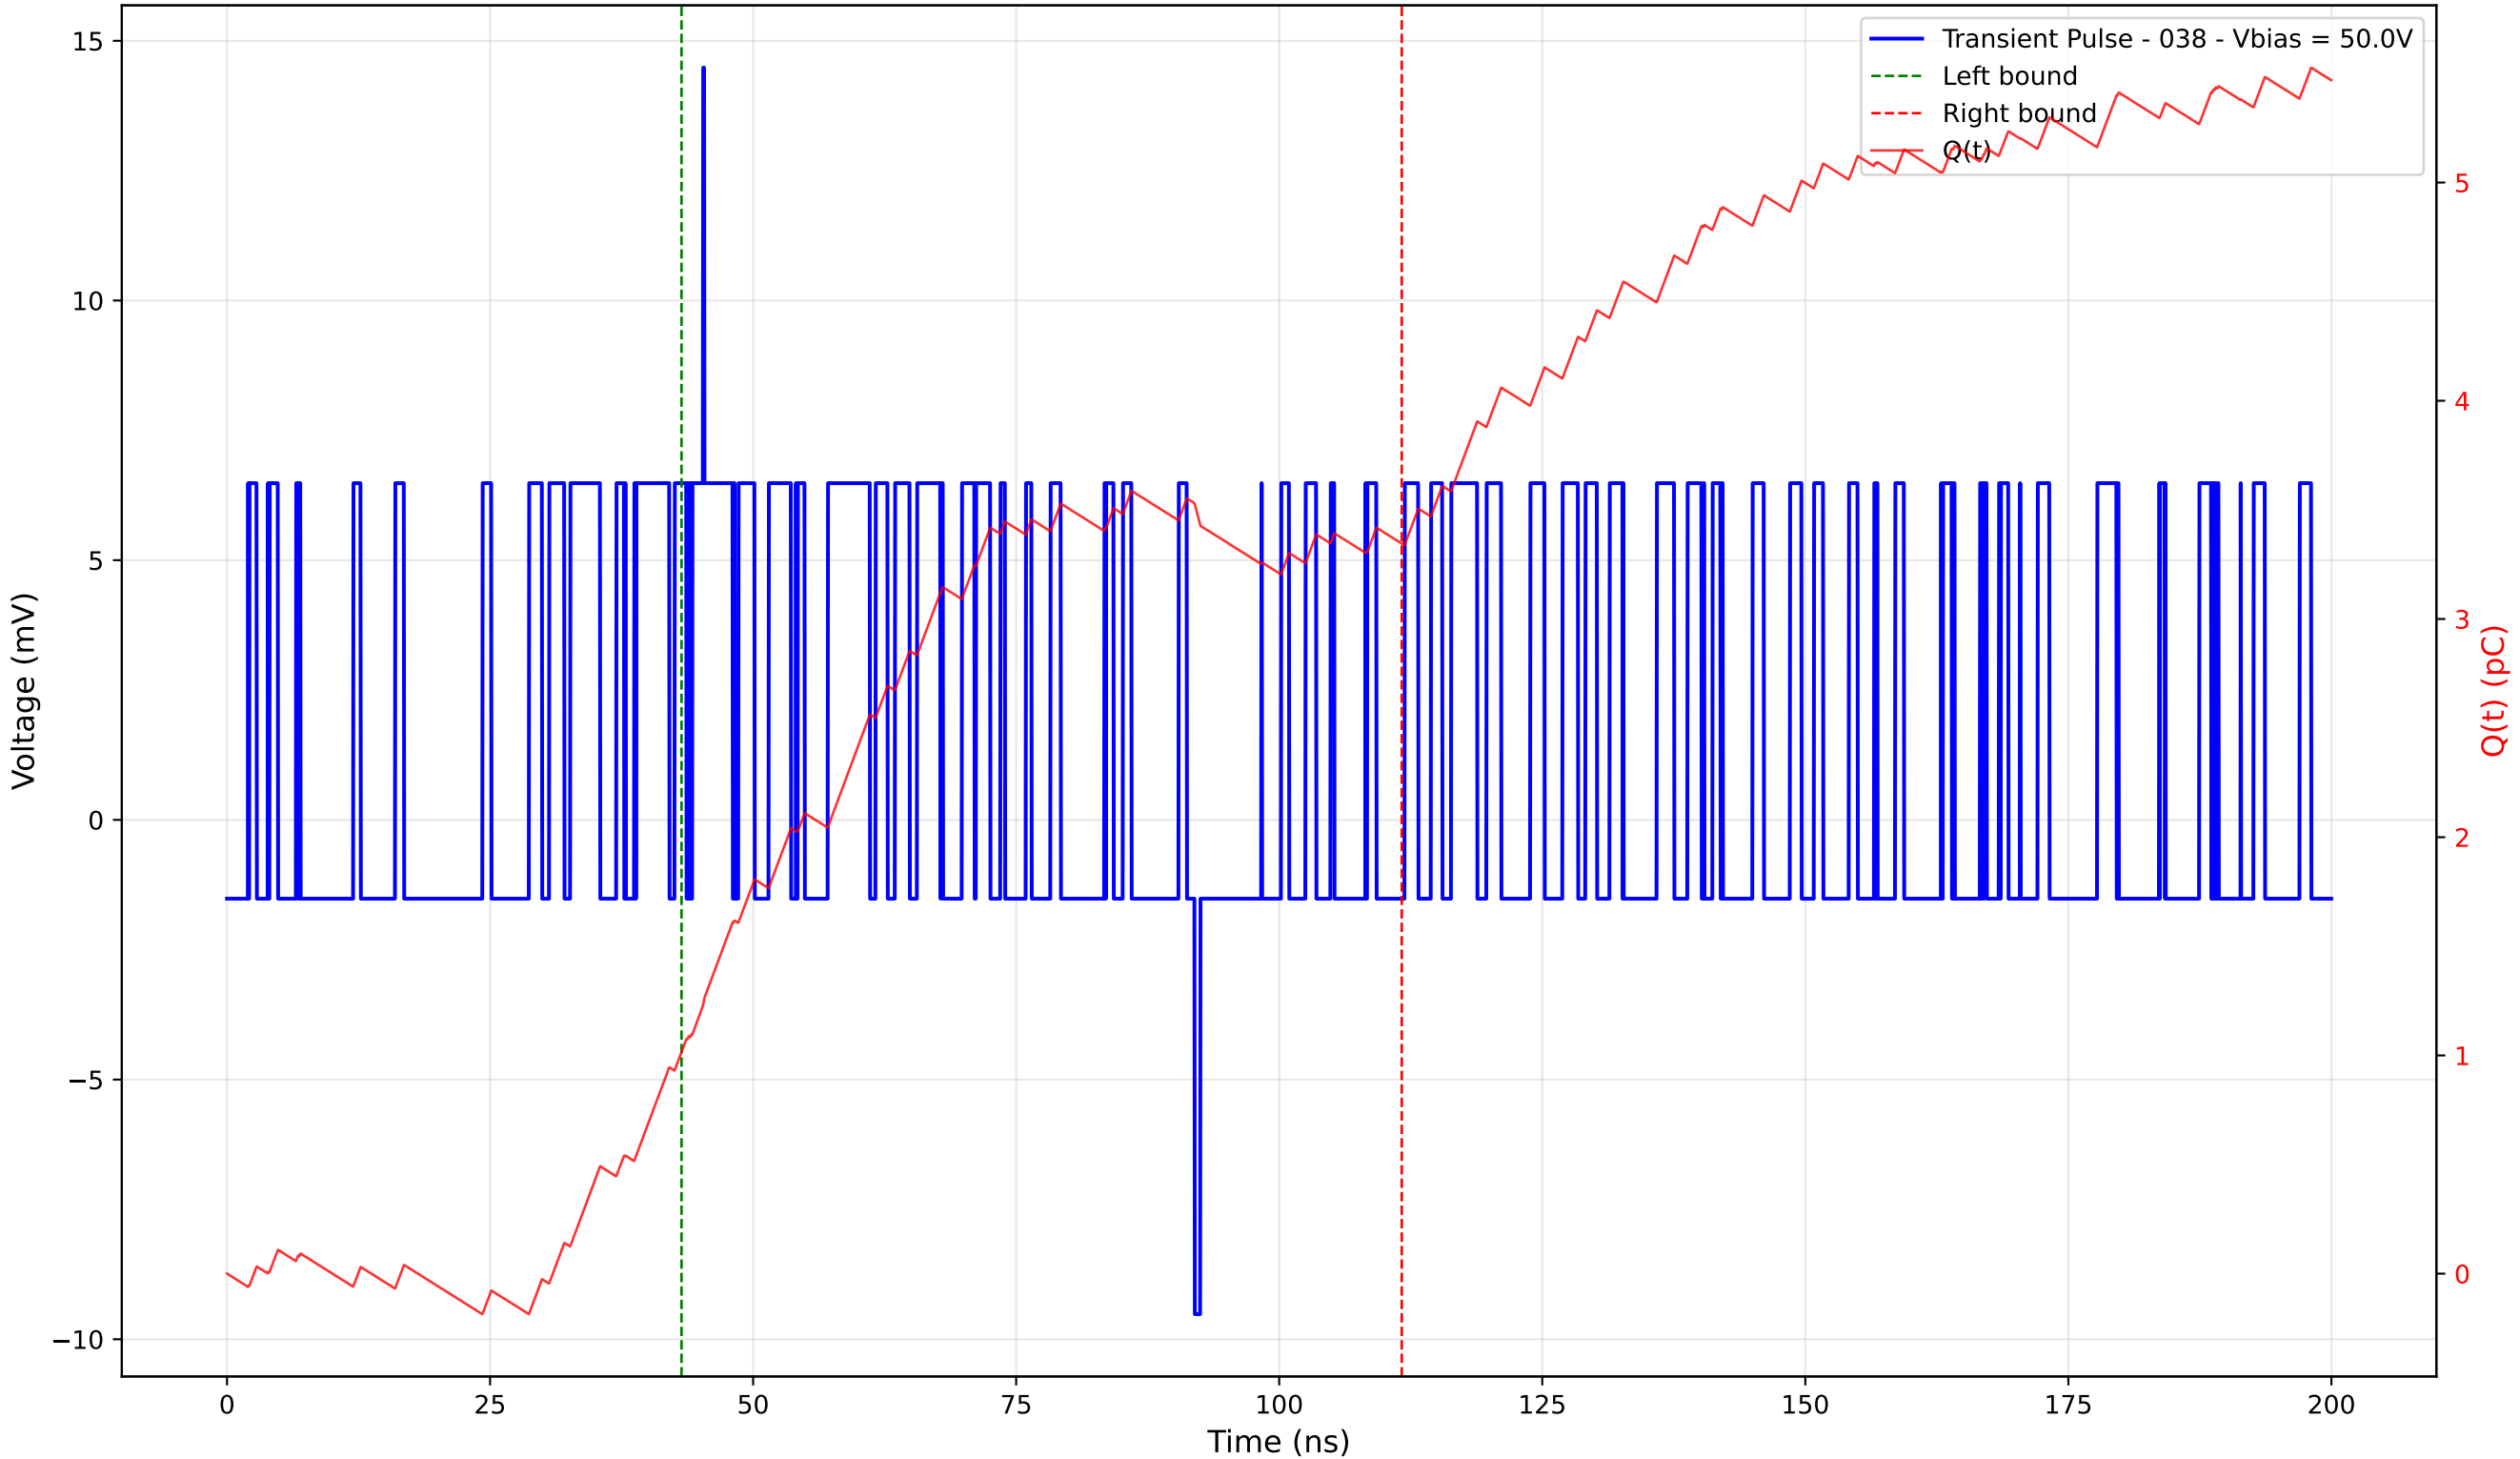


Transient Pulse - Sample: TD_4004 - Position: 20.0 μm - Charge: 3.51 pC - Rise Time: 0.00 ns (N/A)

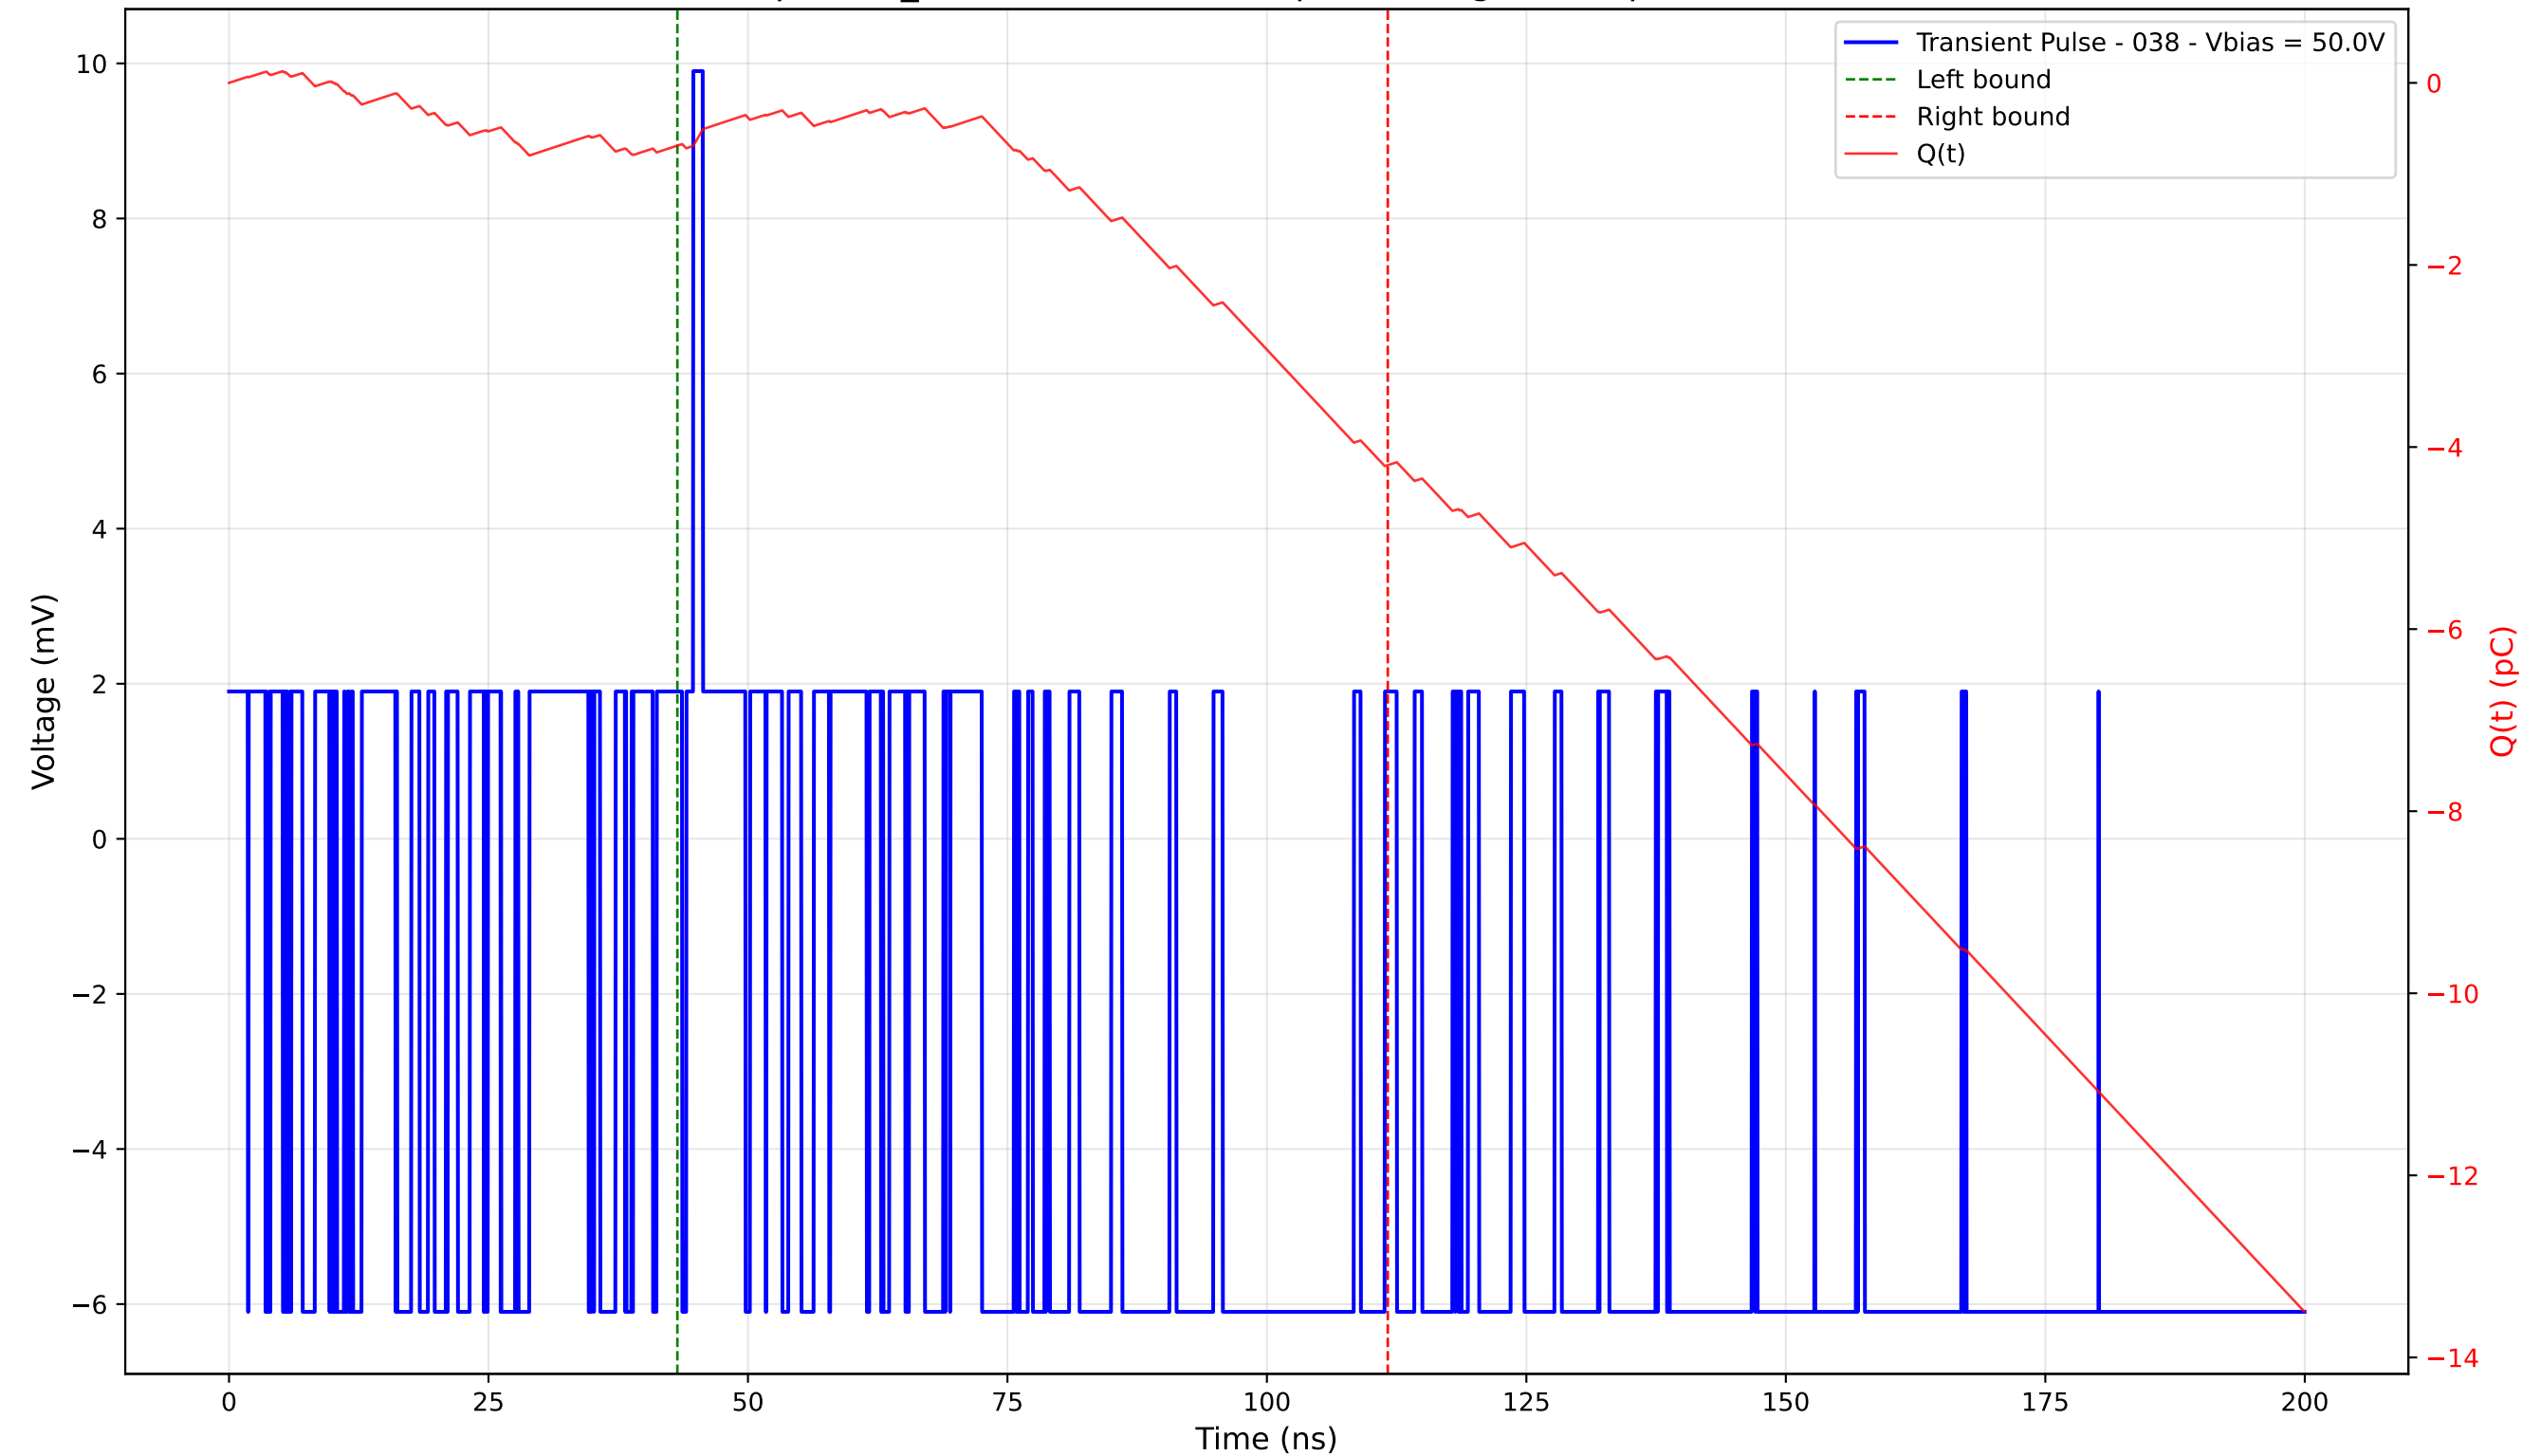


Transient Pulse - Sample: TD_4004 - Position: 25.0 μm - Charge: 3.42 pC - Rise Time: 0.00 ns (N/A)

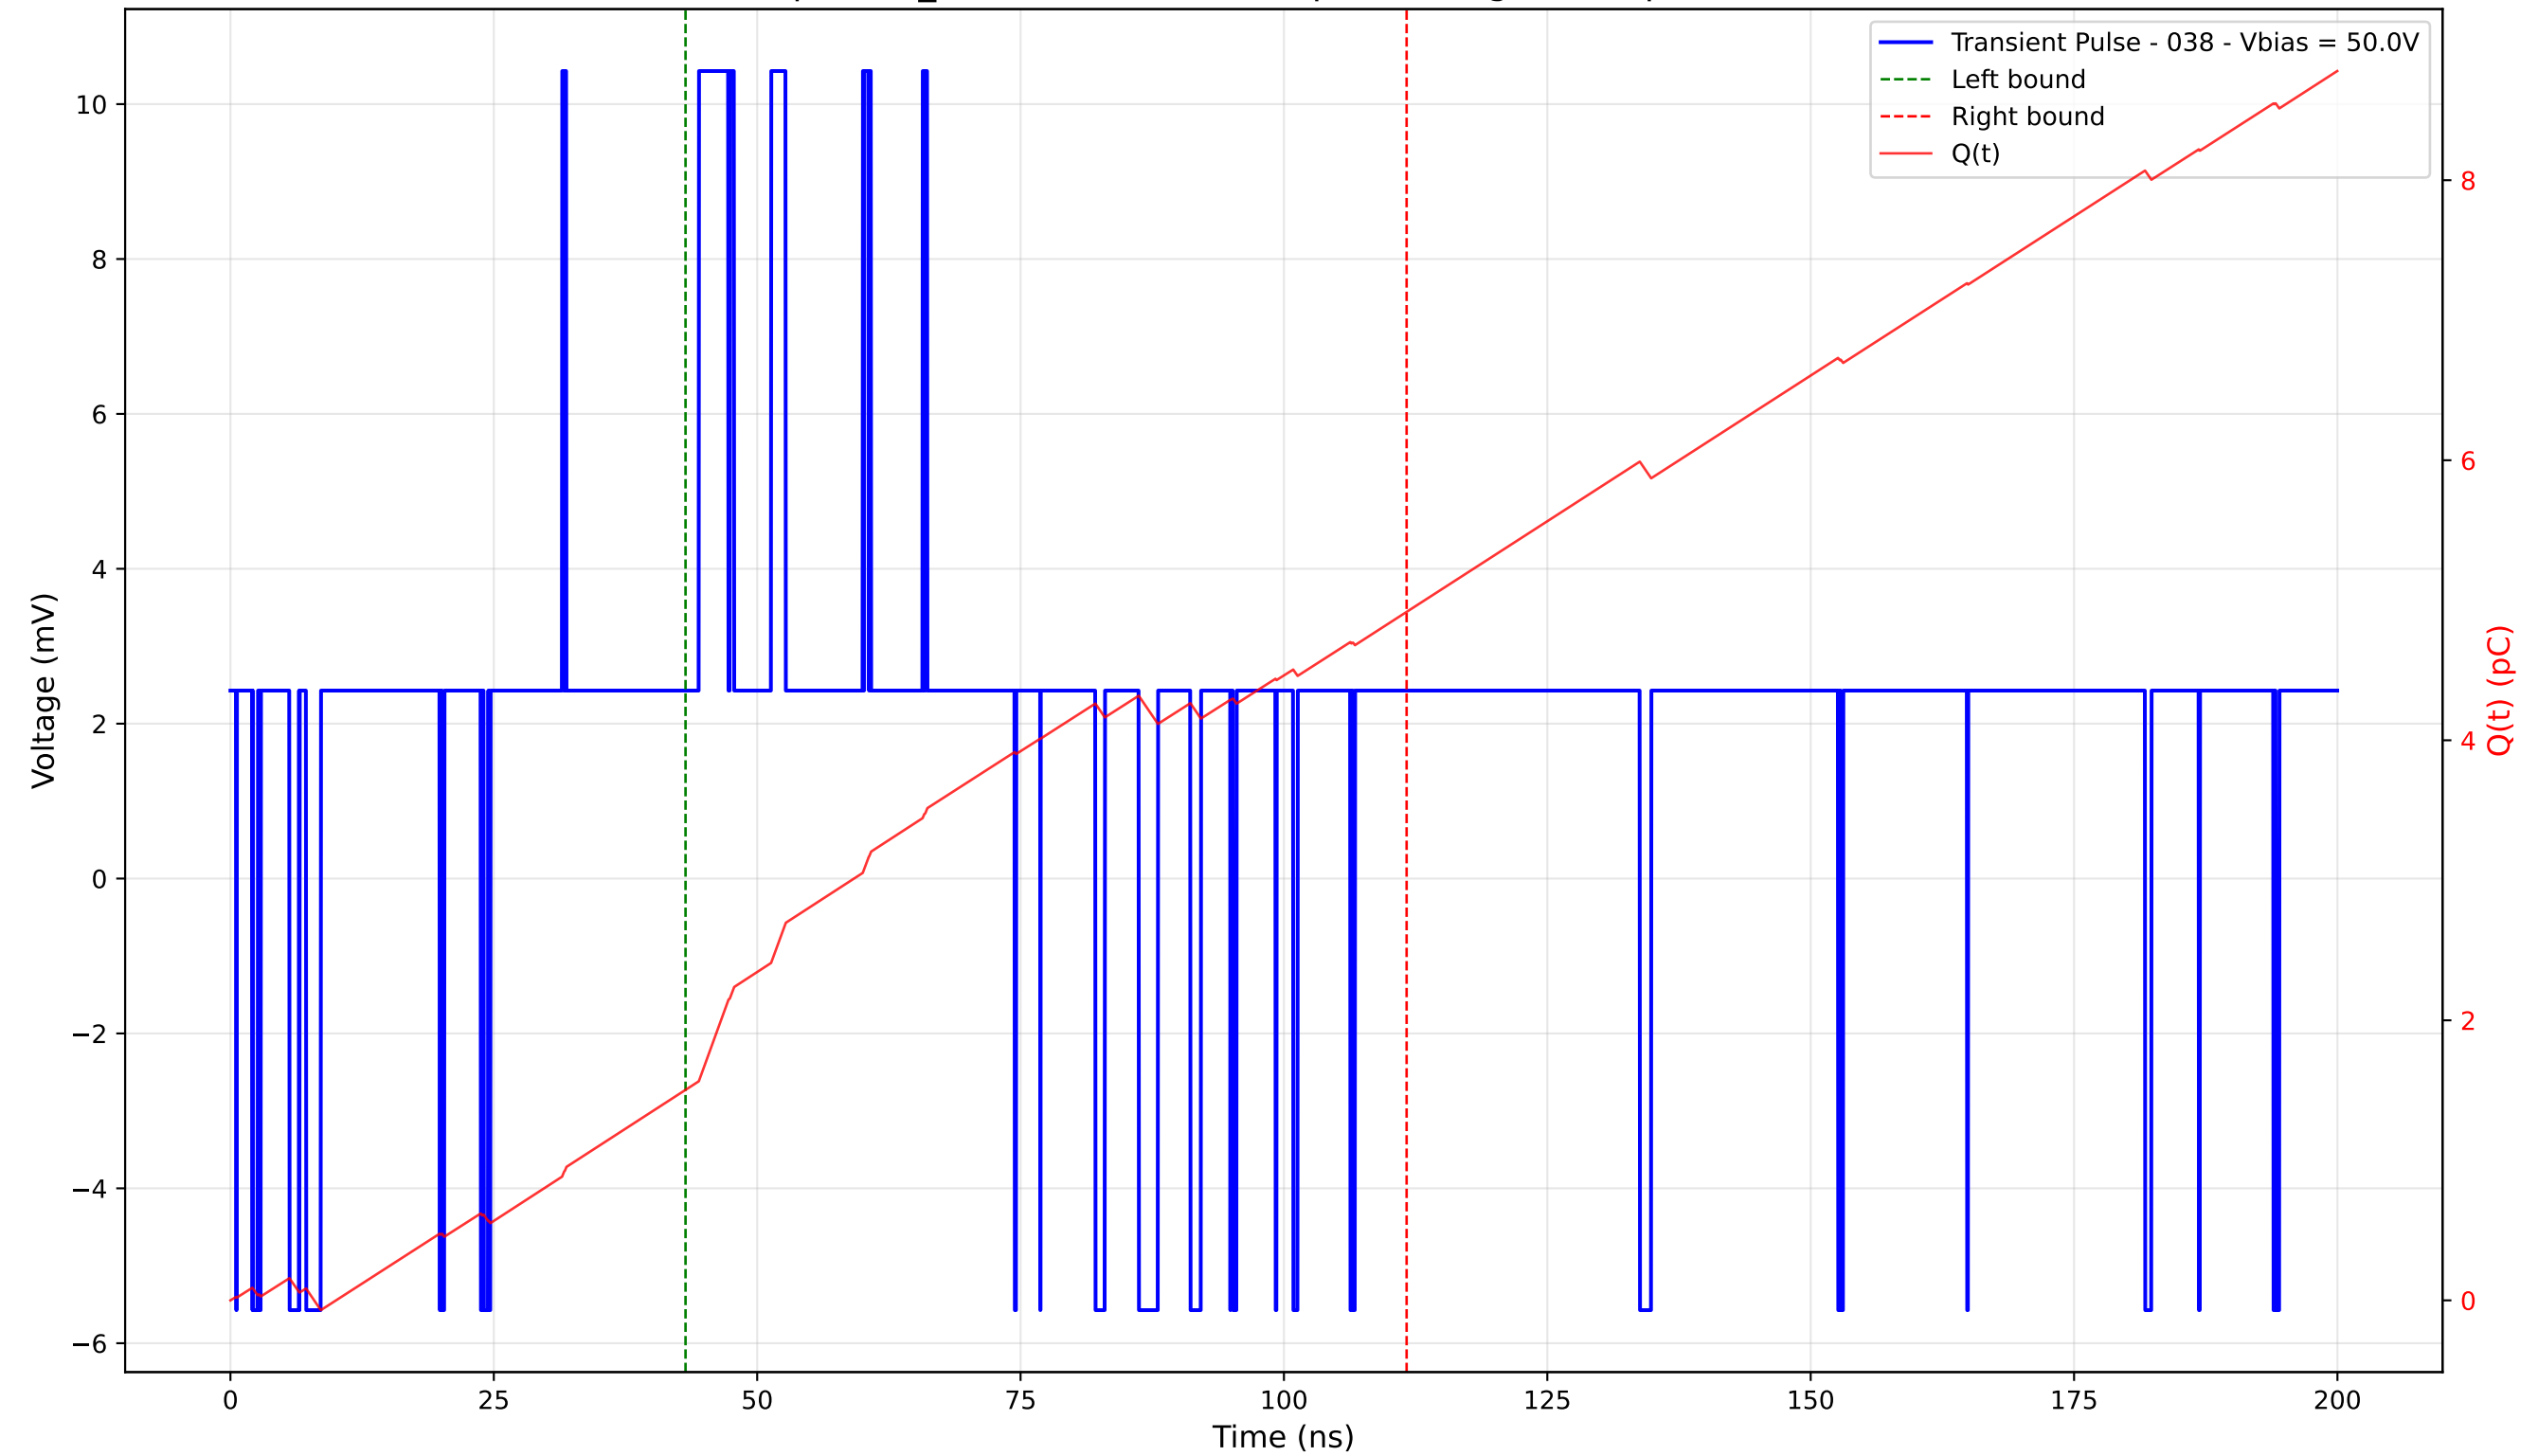


Transient Pulse - Sample: TD_4004 - Position: 30.0 μm - Charge: 0.61 pC - Rise Time: 0.00 ns (N/A)

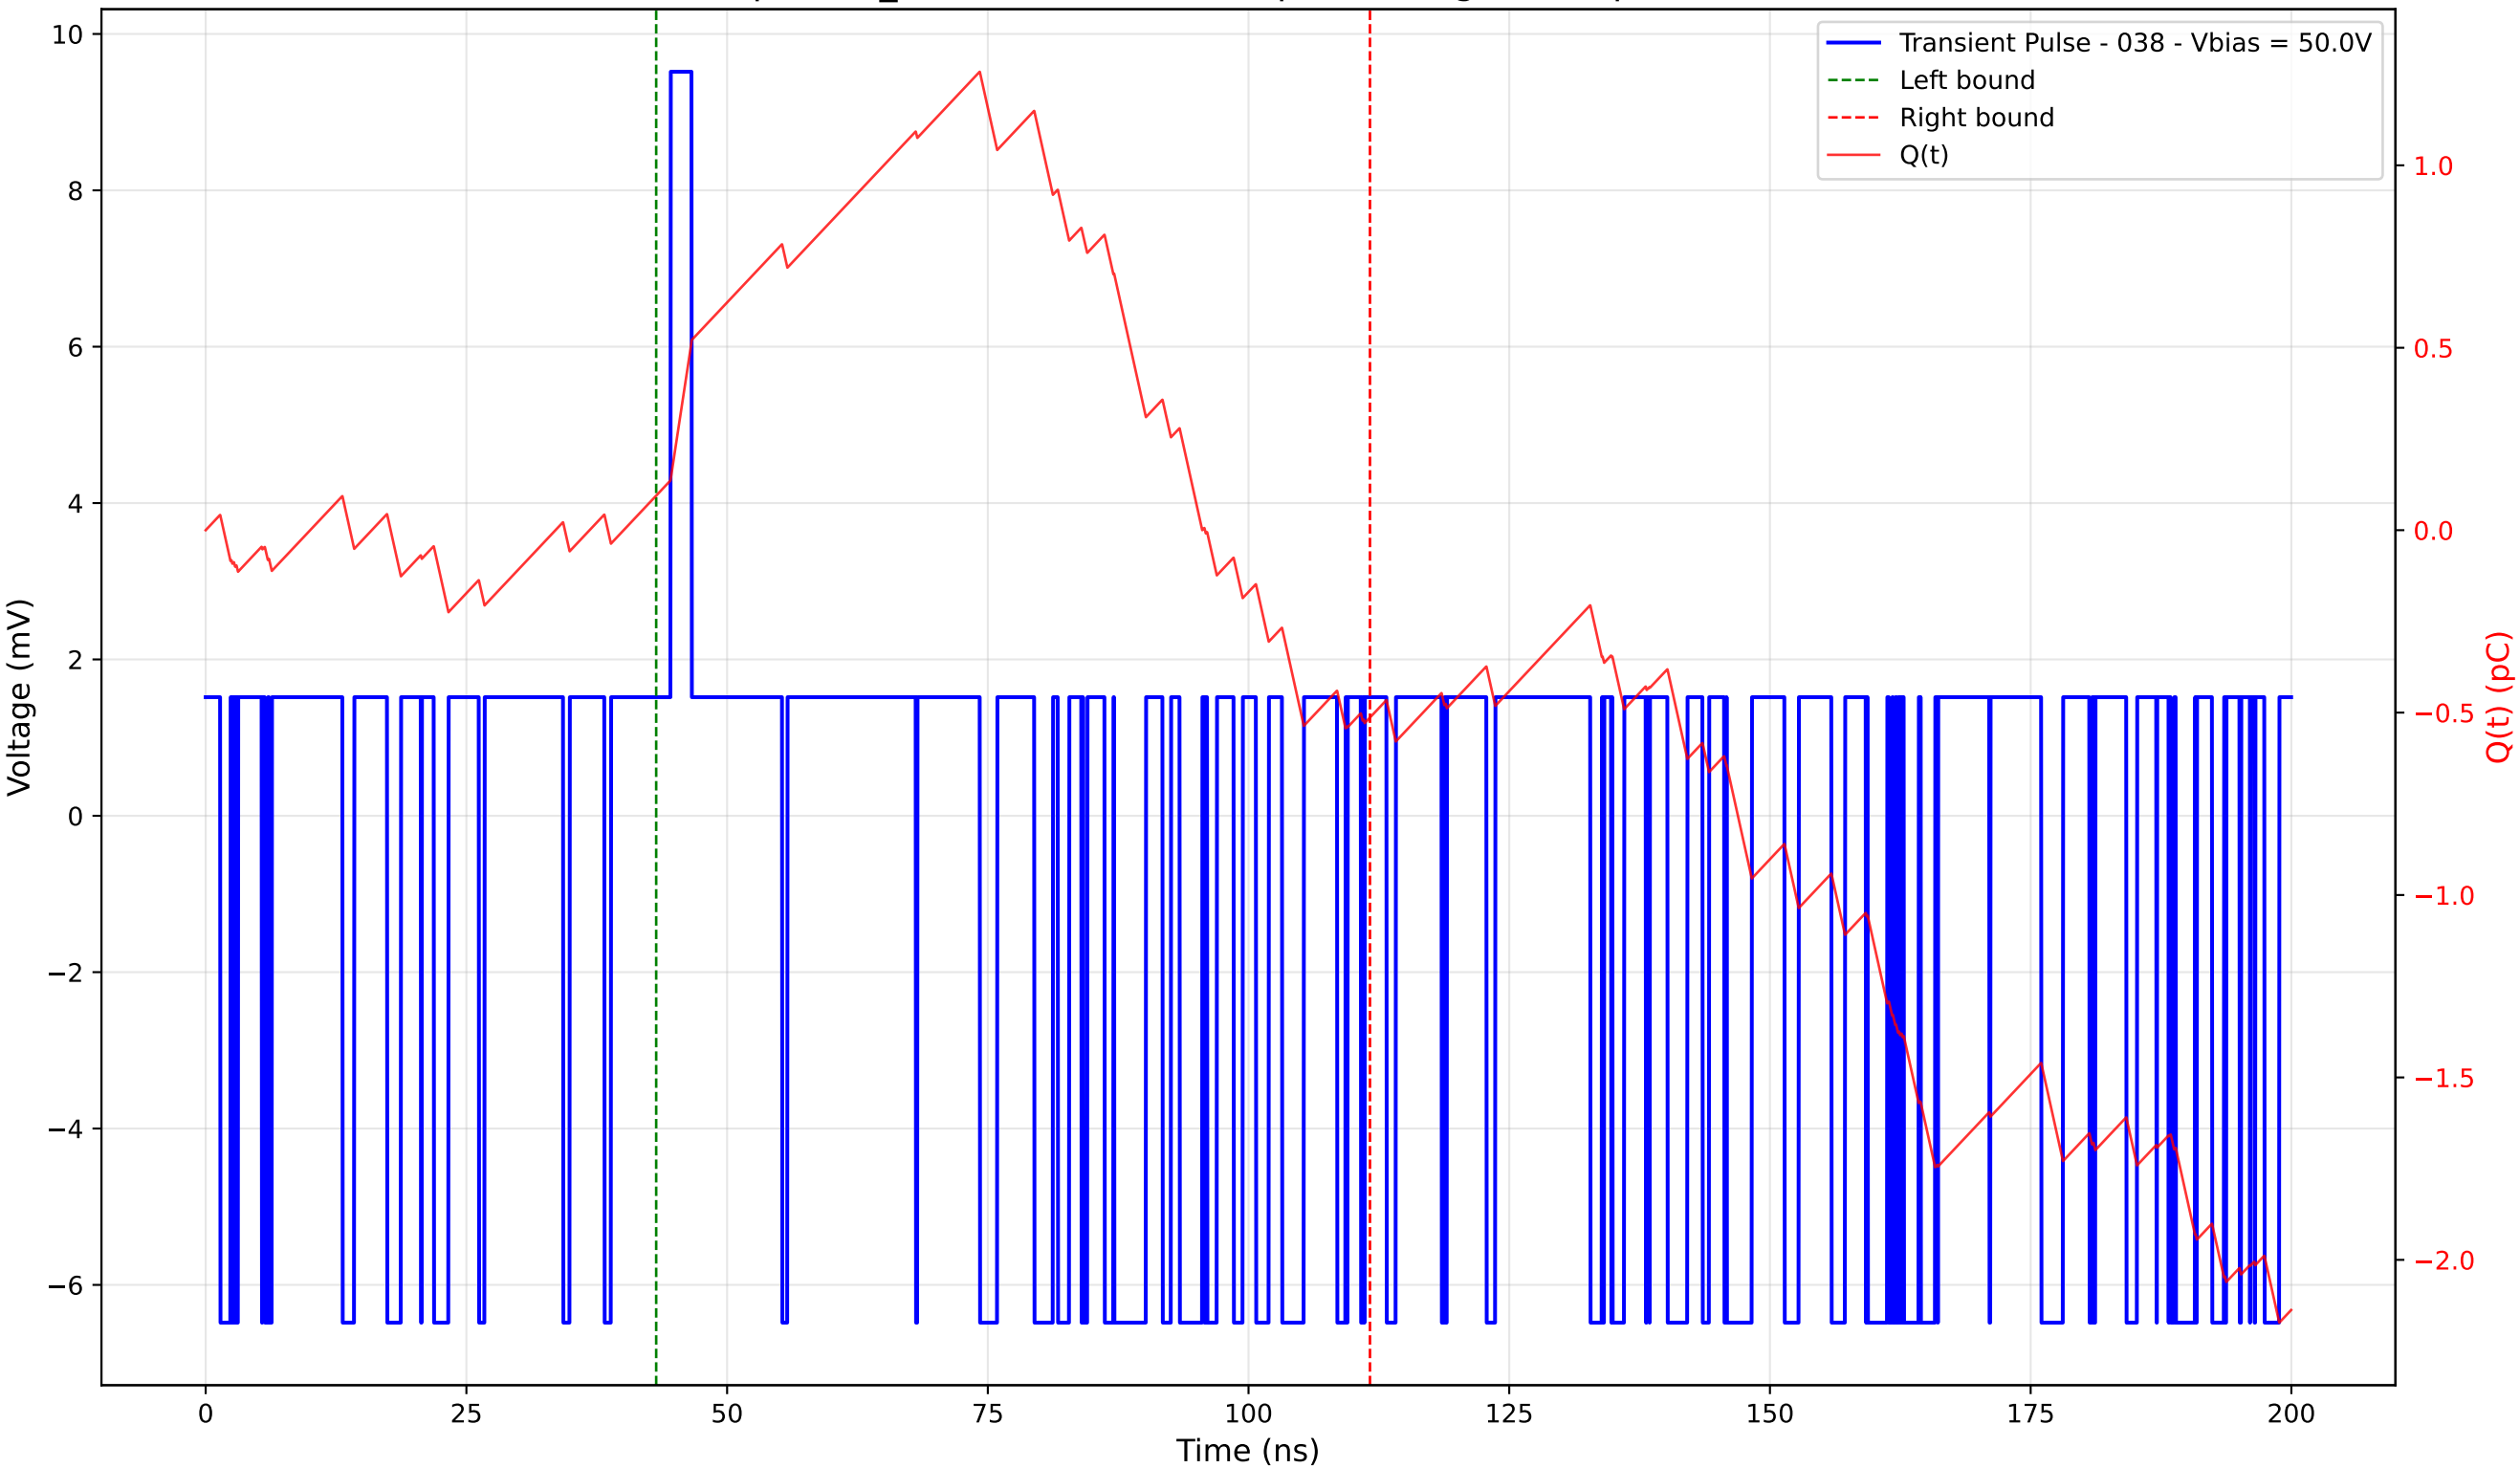


Transient Pulse - Sample: TD_4004 - Position: 35.0 μm - Charge: 2.87 pC - Rise Time: 0.00 ns (N/A)

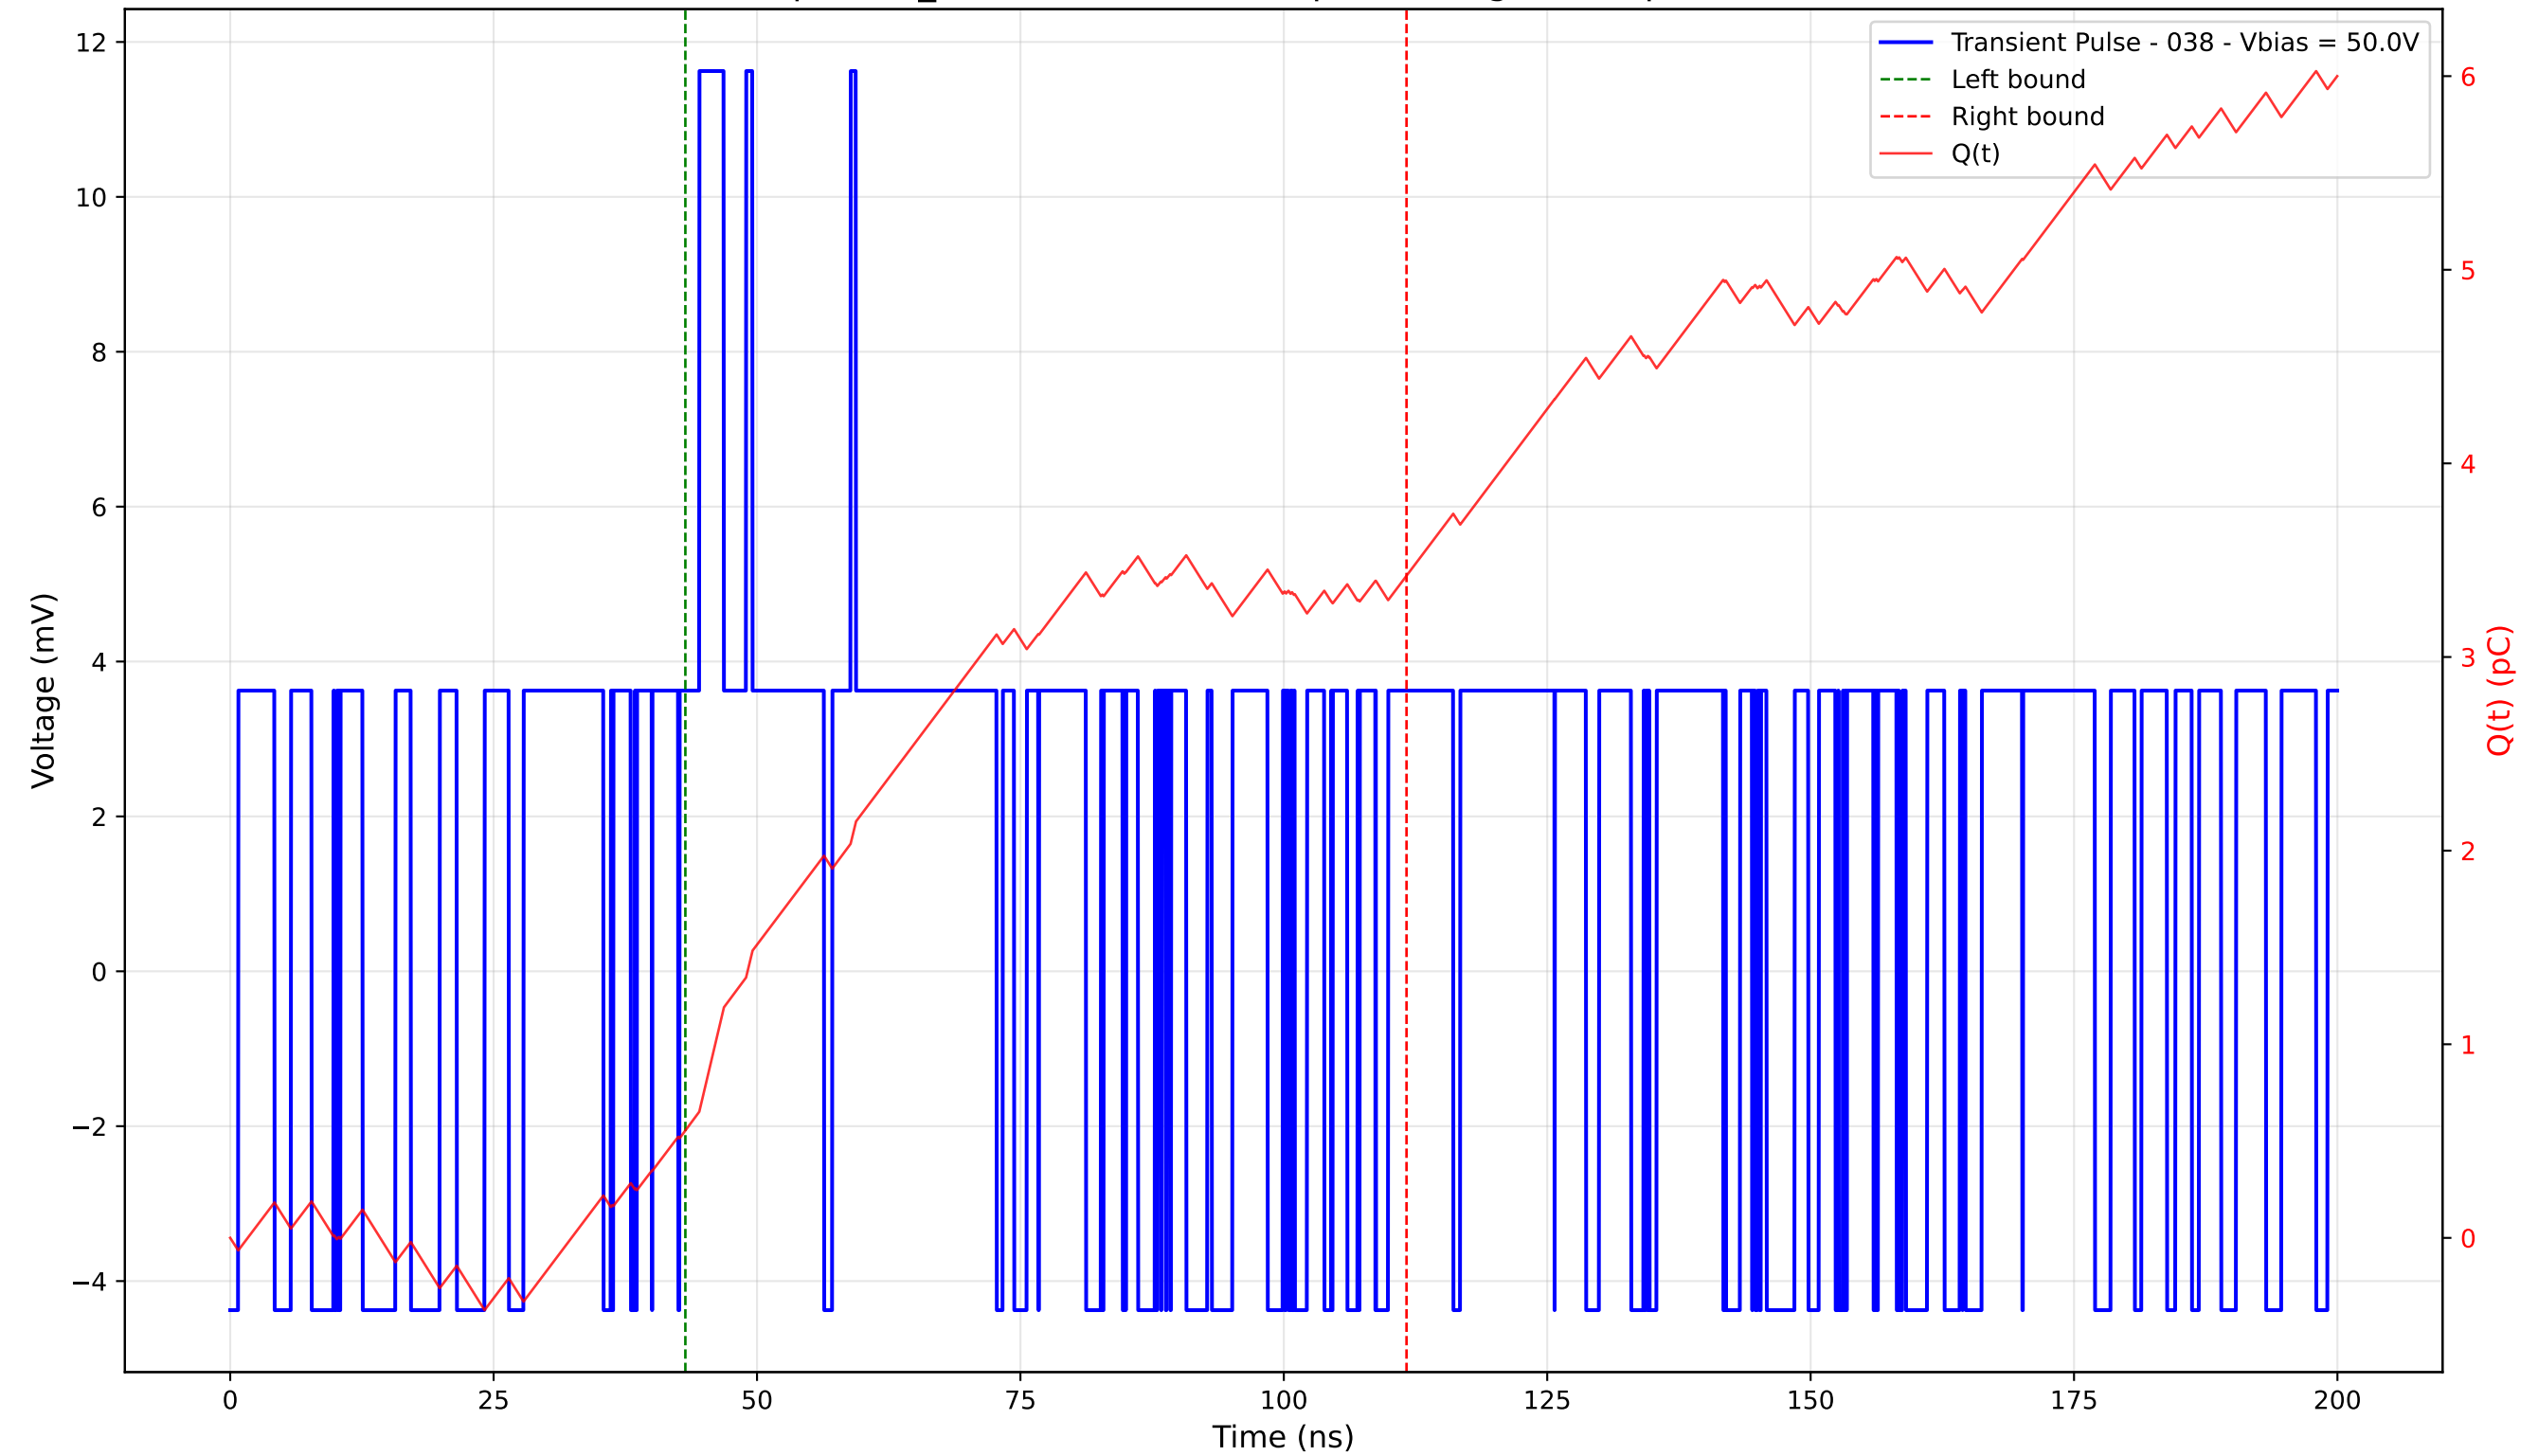


Transient Pulse - Sample: TD_4004 - Position: 40.0 μm - Charge: 1.03 pC - Rise Time: 0.00 ns (N/A)

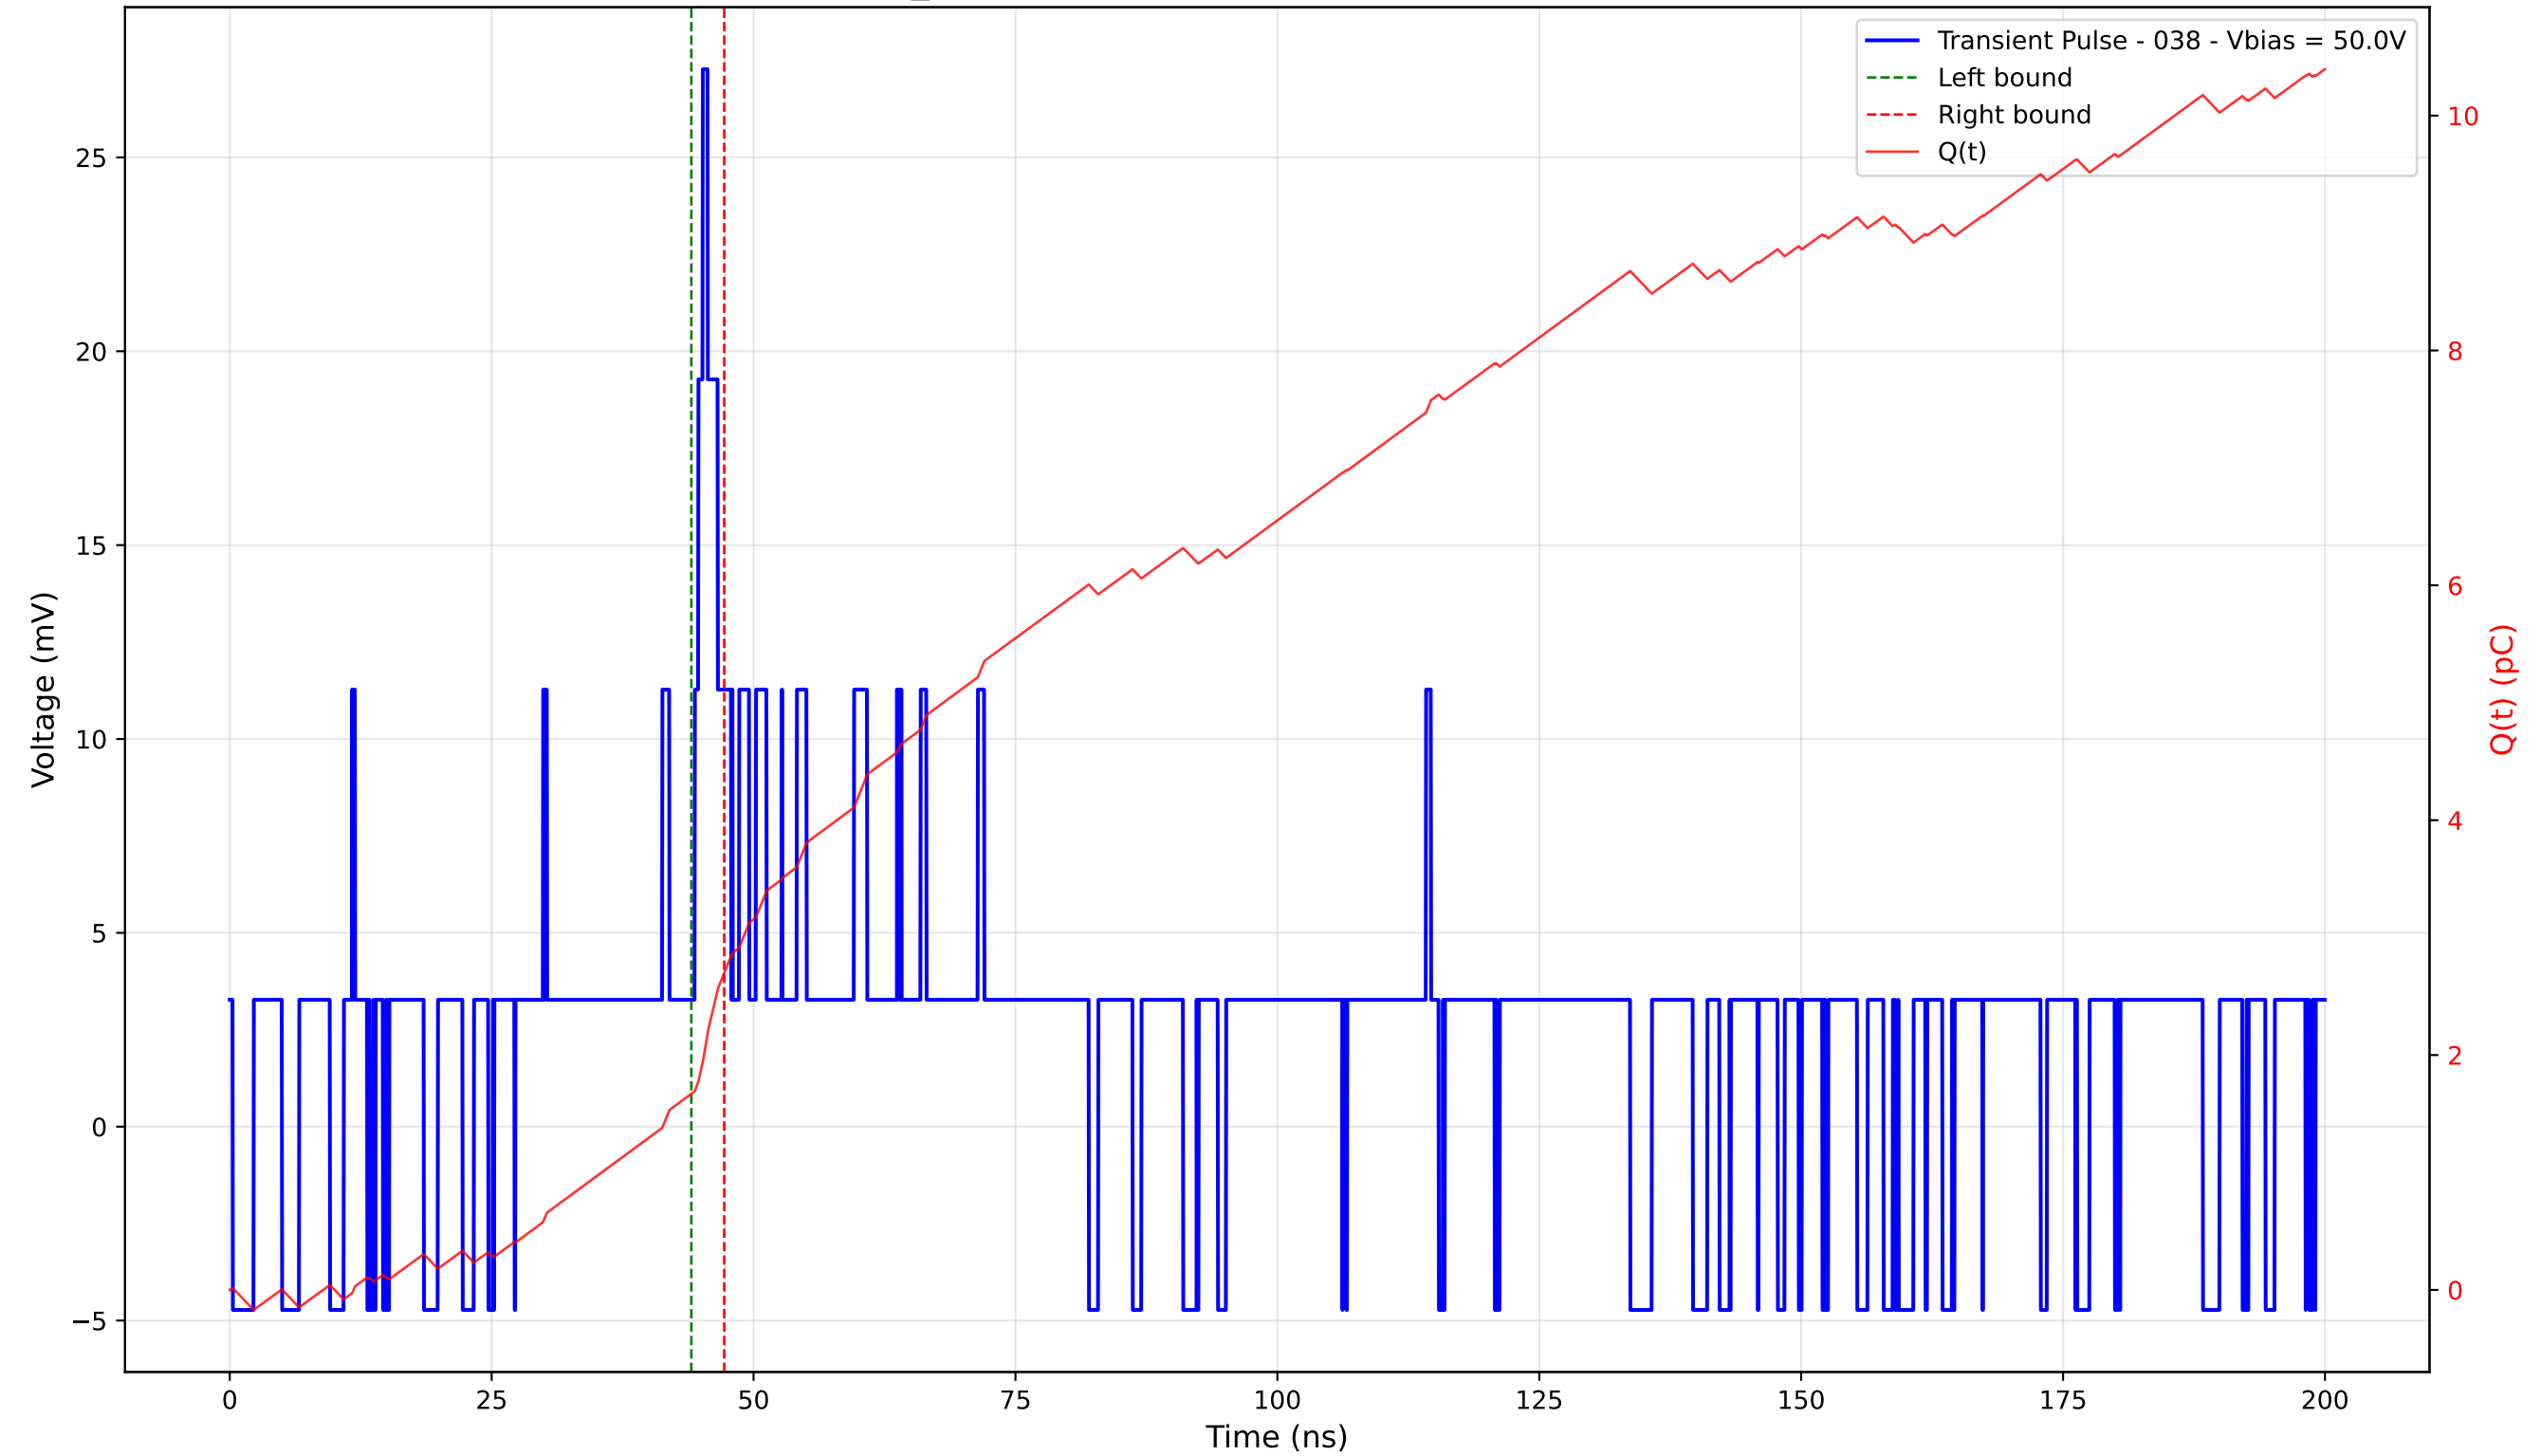


Transient Pulse - Sample: TD_4004 - Position: 45.0 μm - Charge: 1.54 pC - Rise Time: 1.04 ns

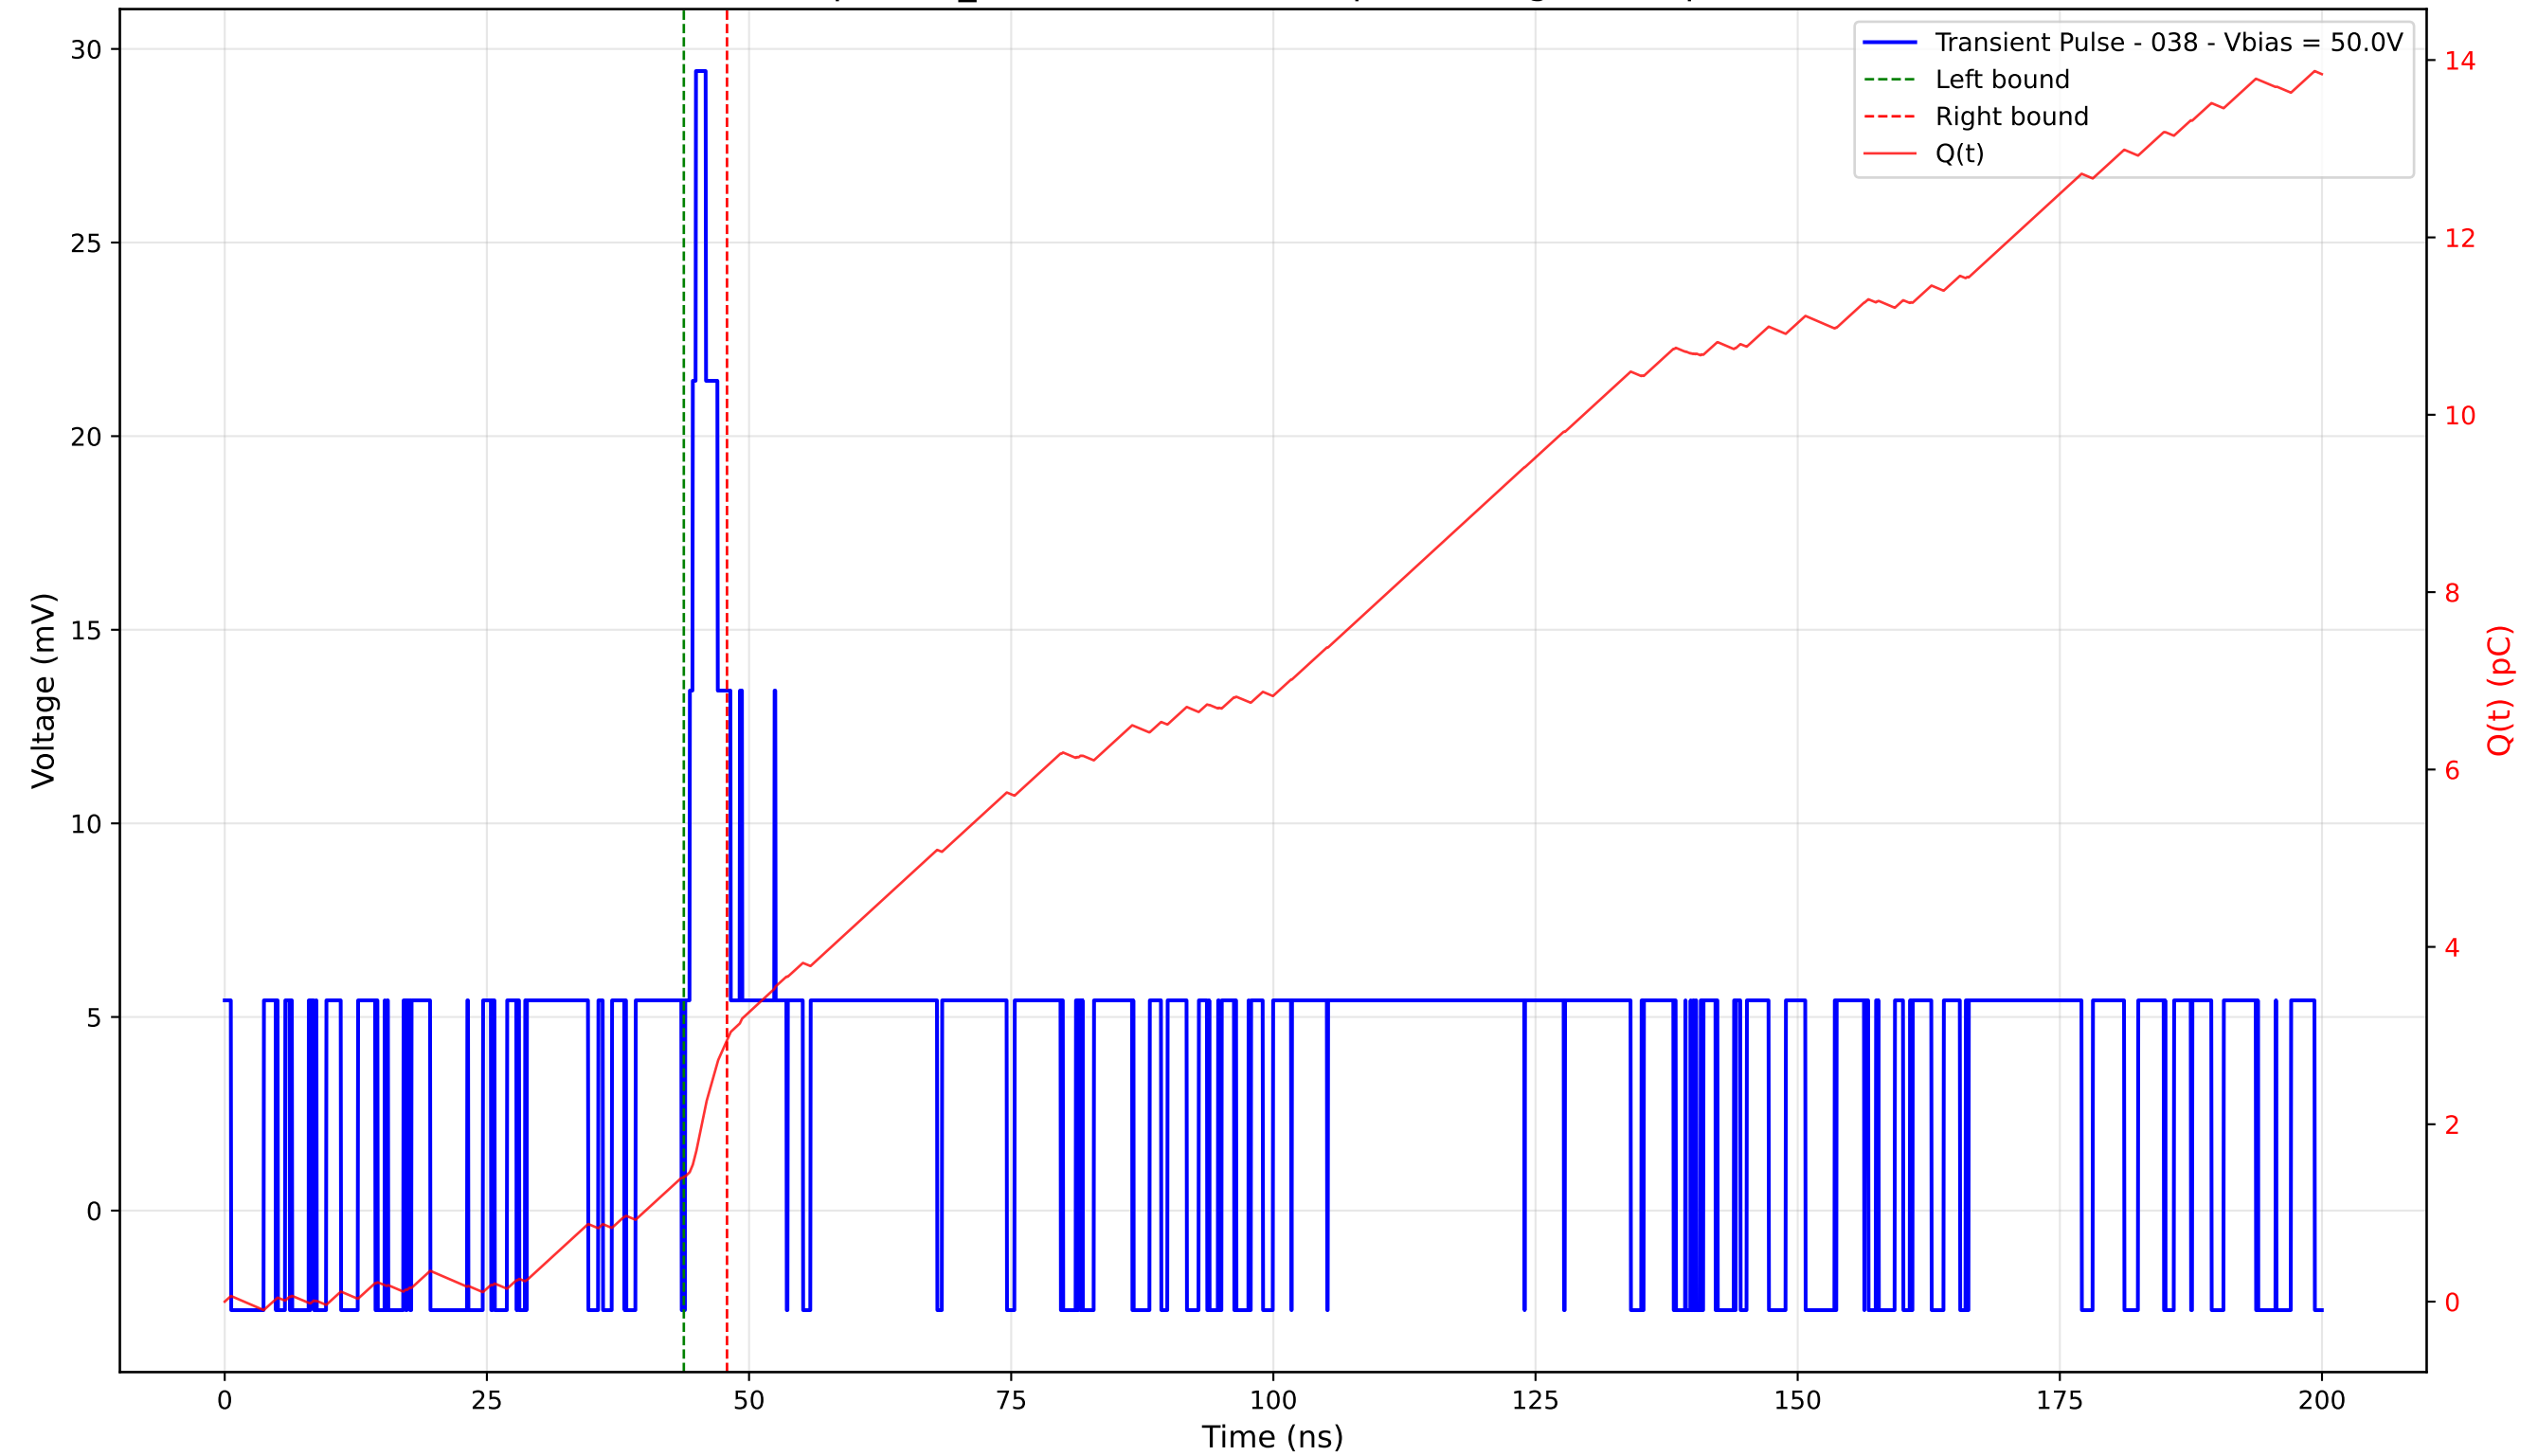


Transient Pulse - Sample: TD_4004 - Position: 50.0 μm - Charge: 2.67 pC - Rise Time: 1.09 ns

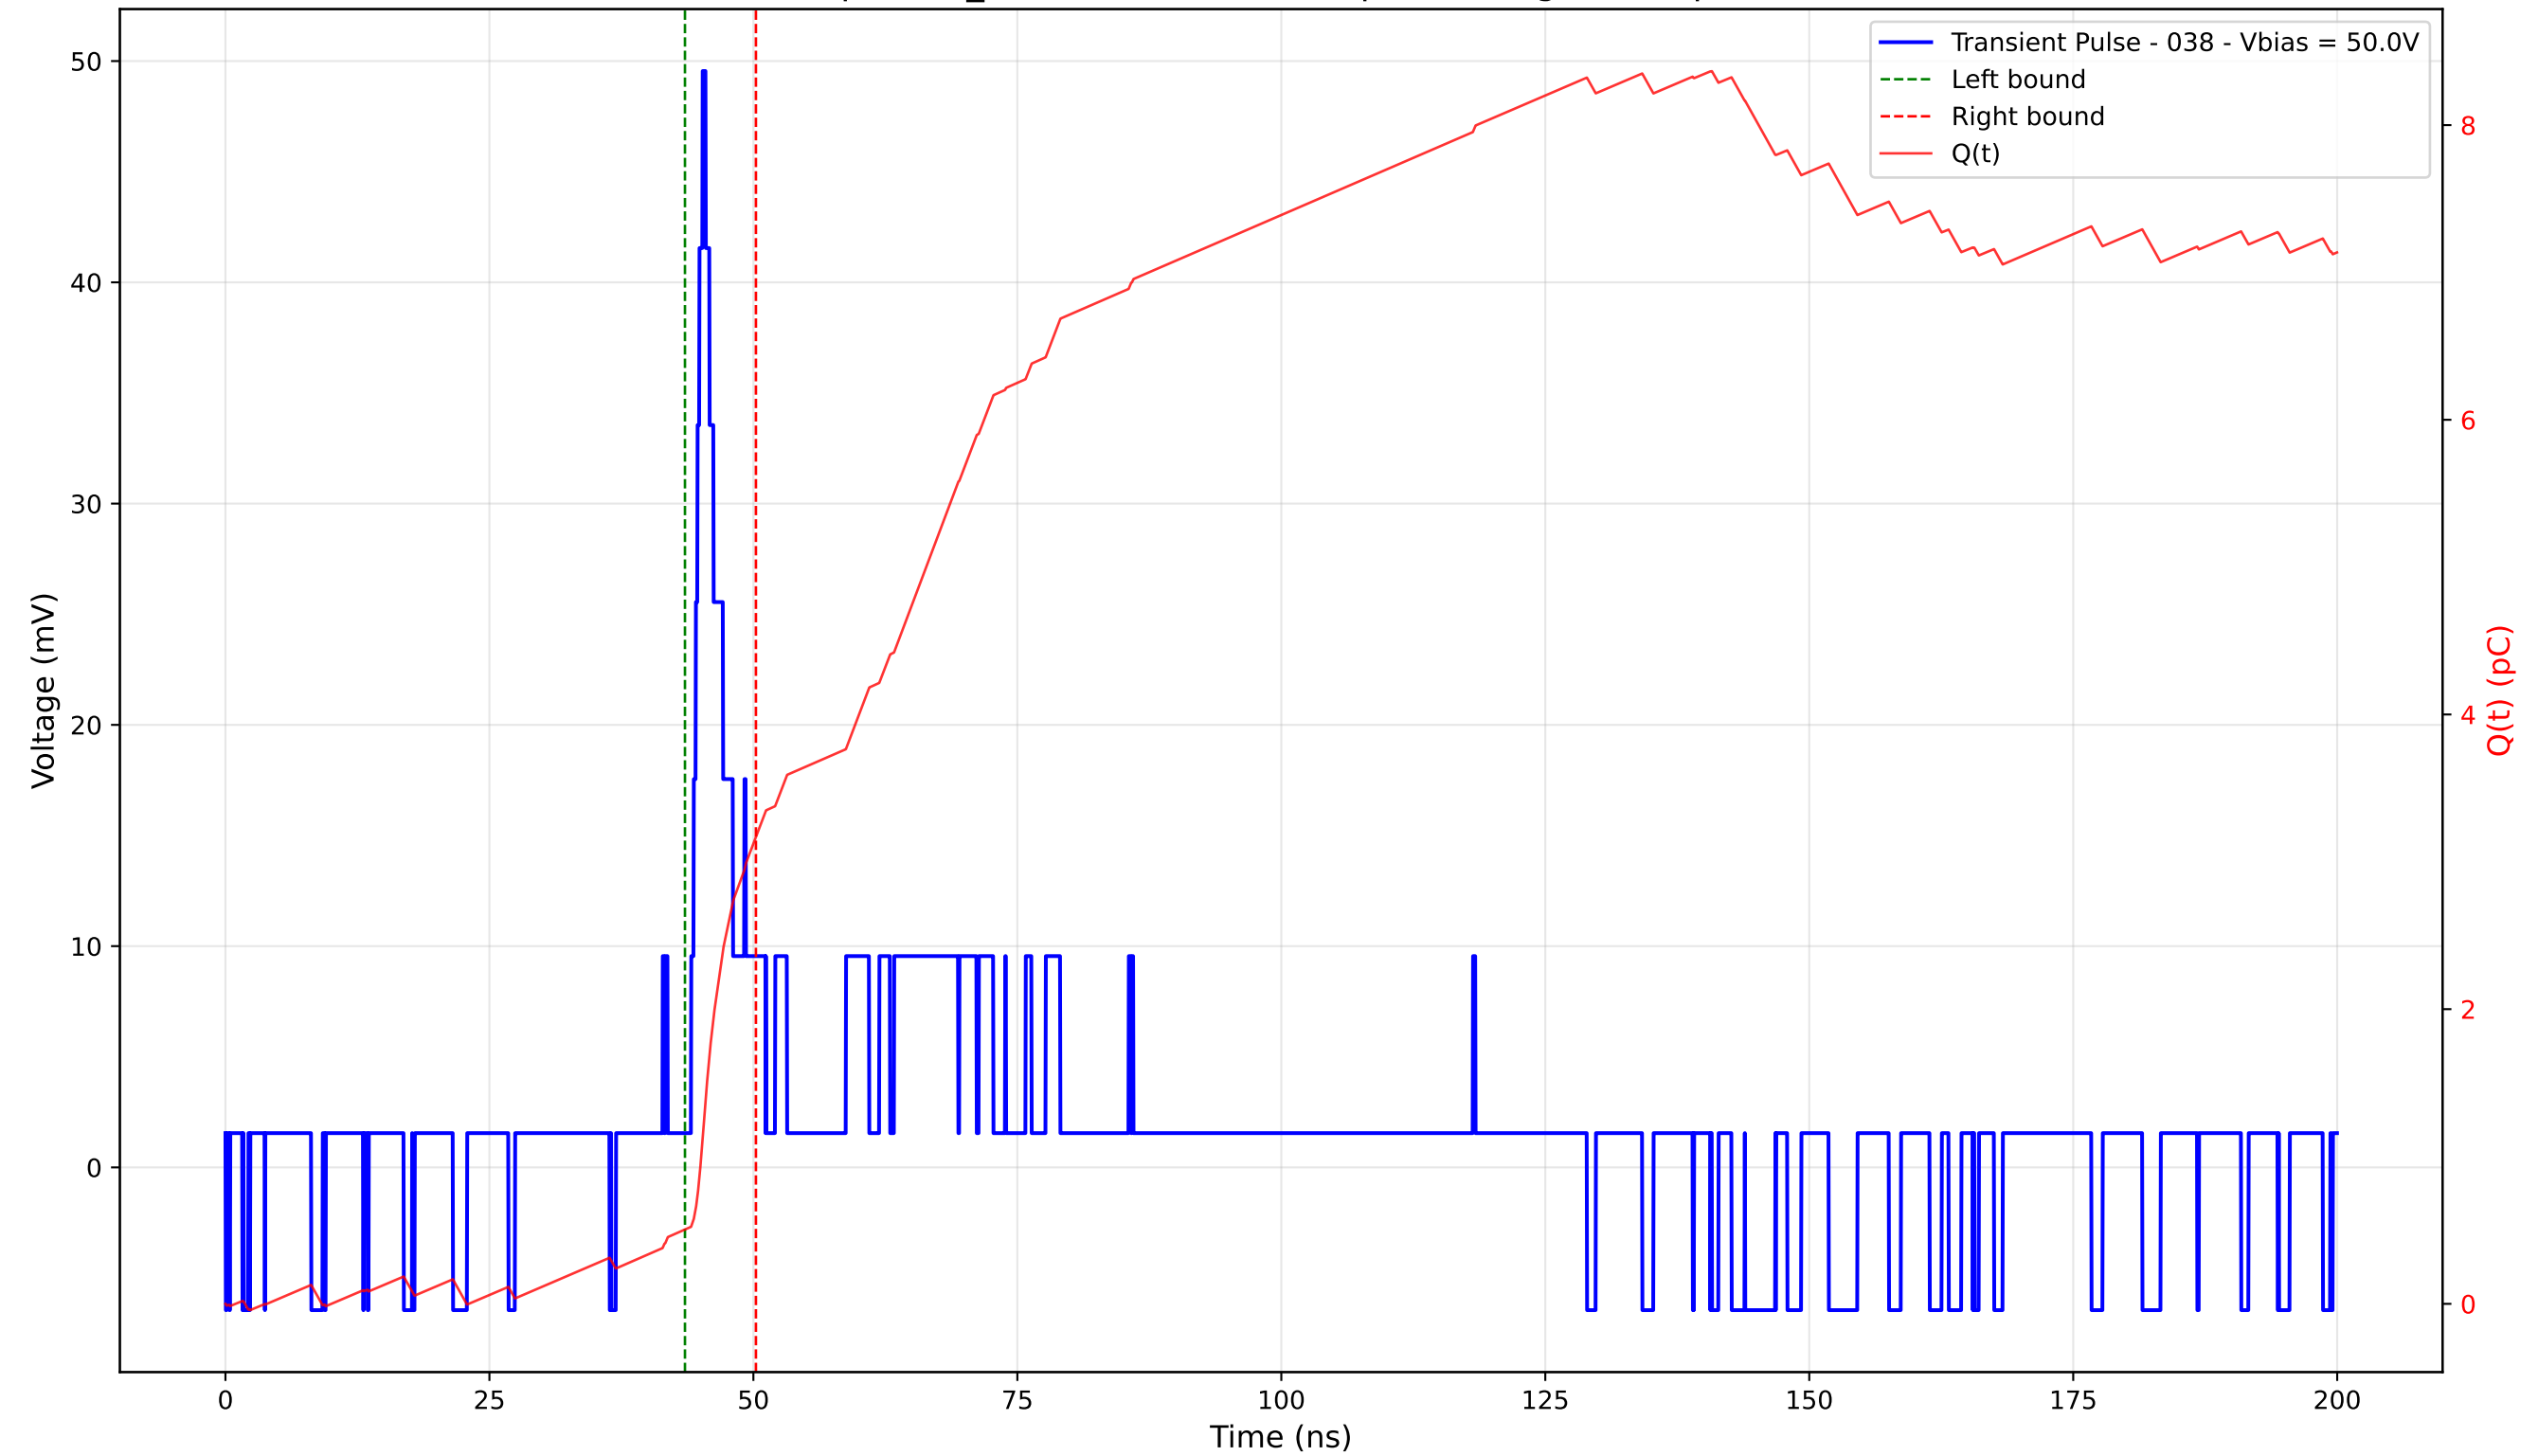


Transient Pulse - Sample: TD_4004 - Position: 55.0 μm - Charge: 4.70 pC - Rise Time: 1.08 ns

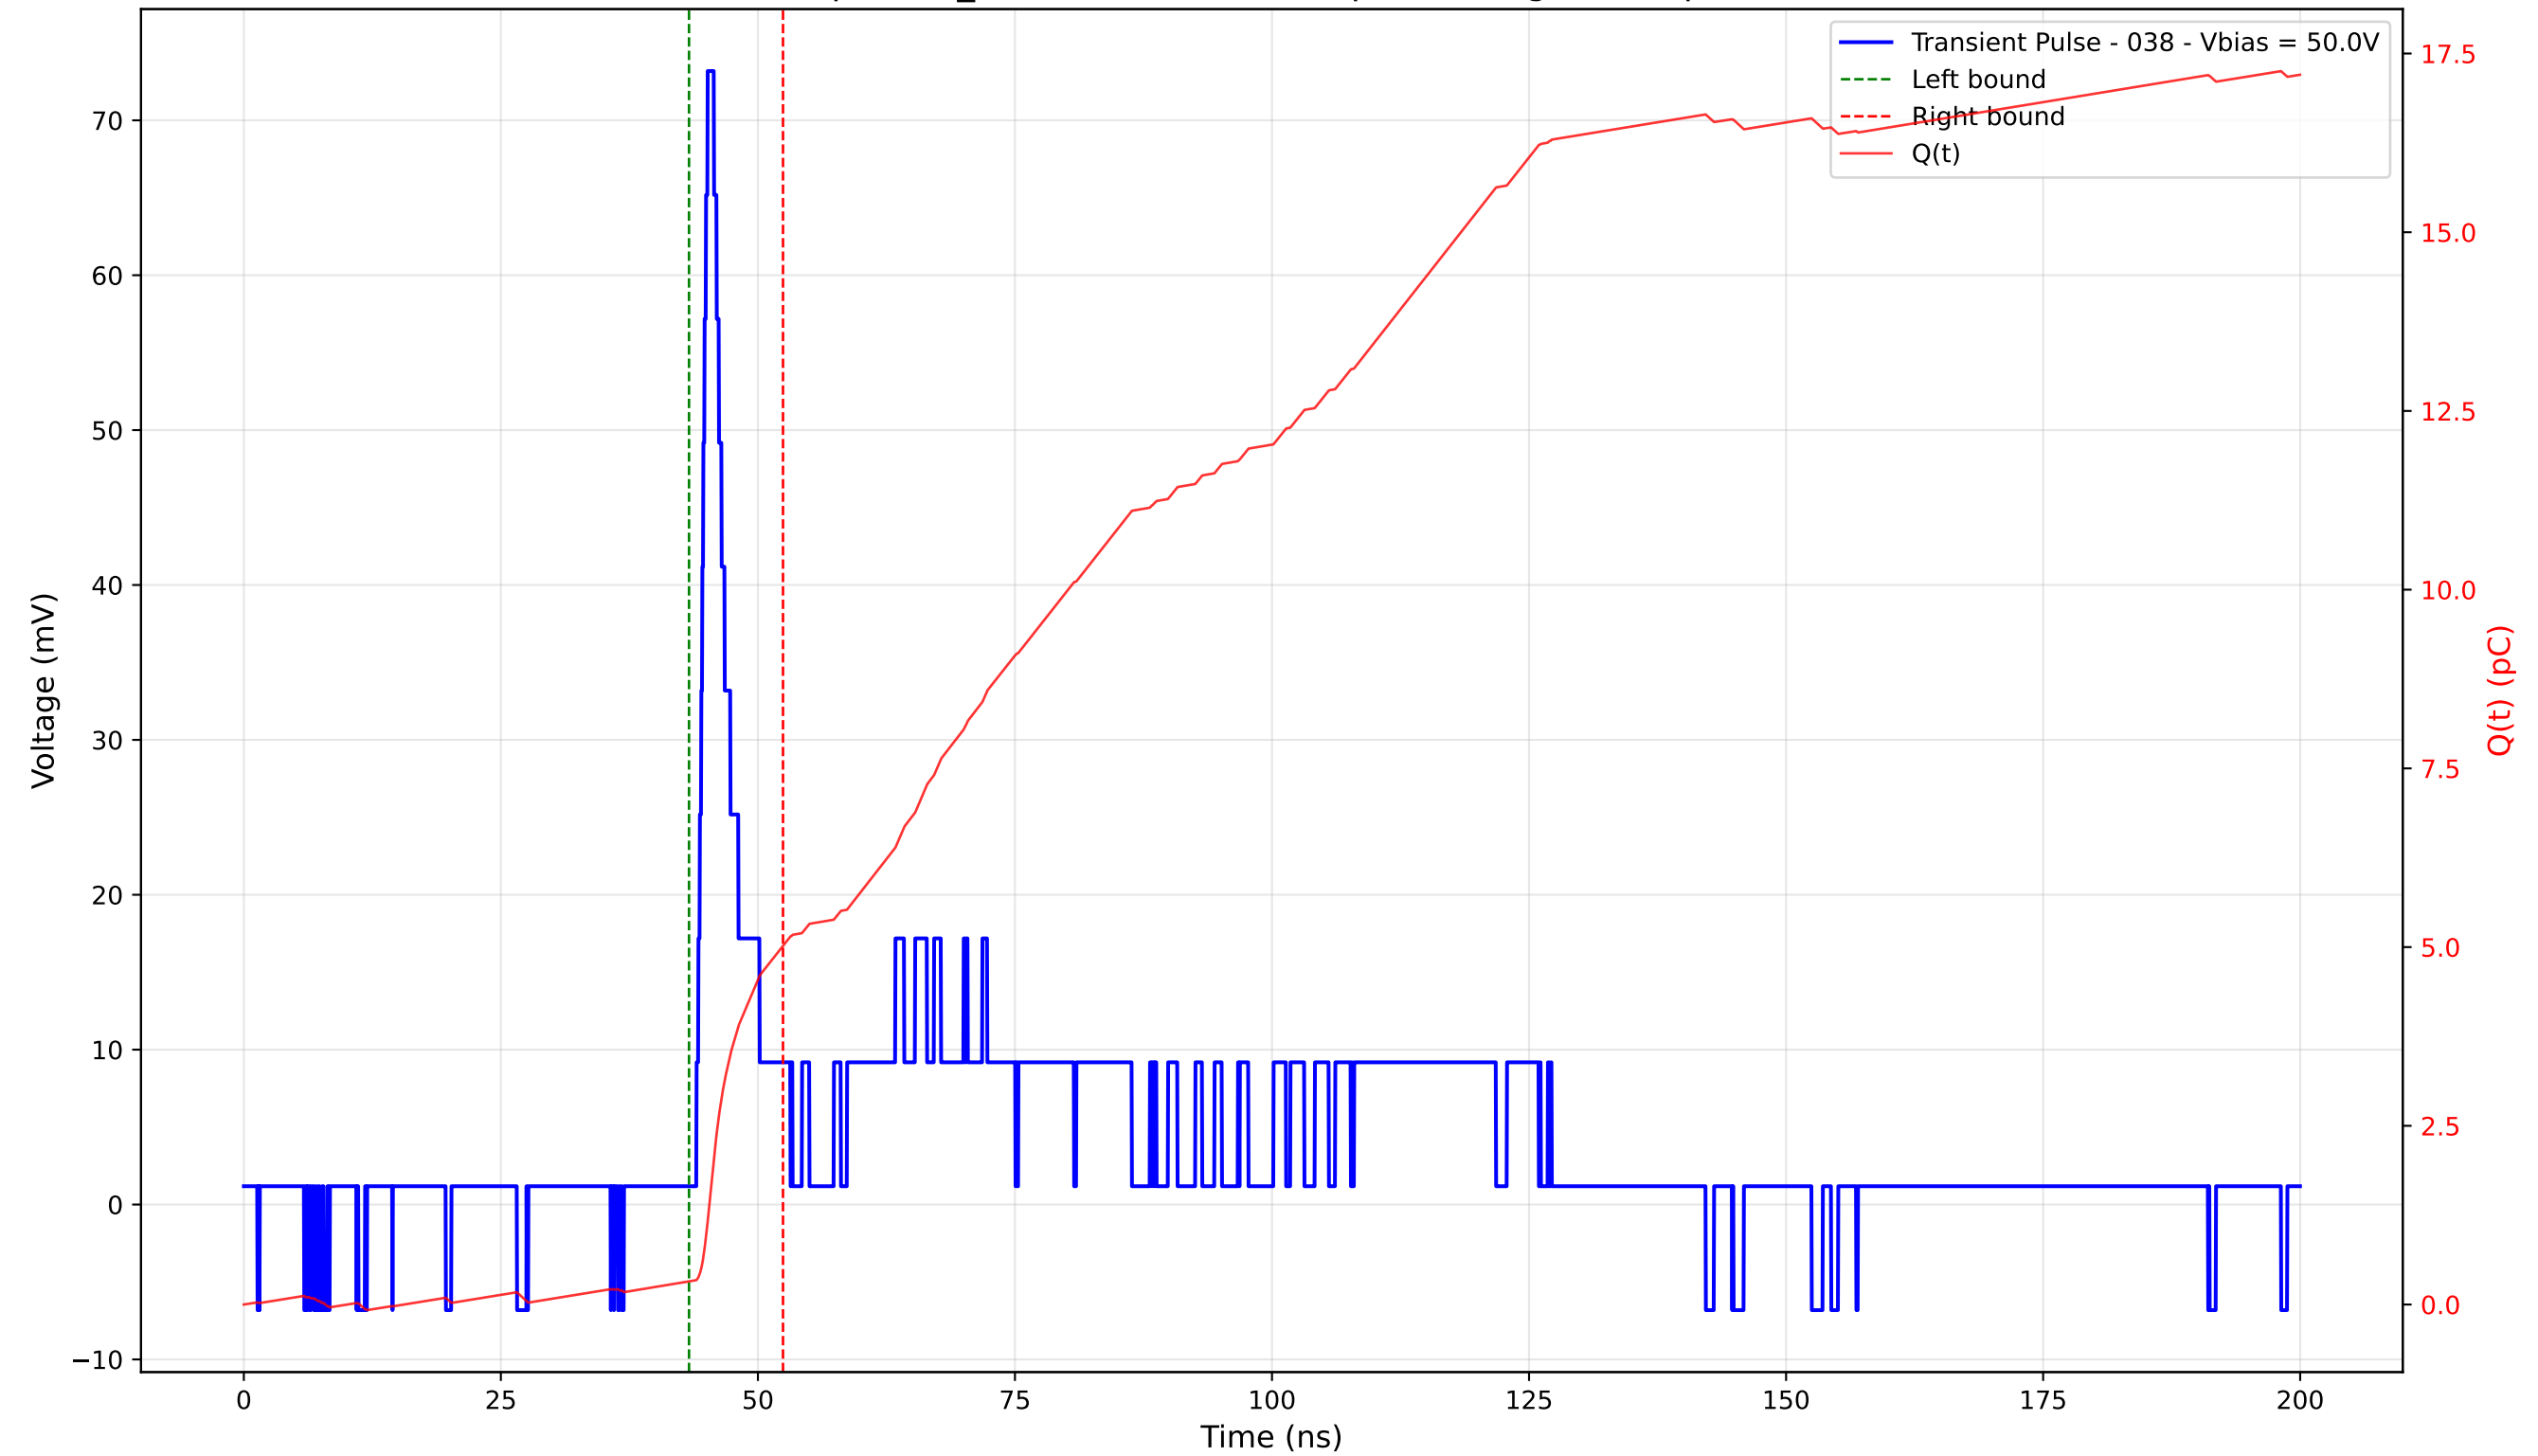


Transient Pulse - Sample: TD_4004 - Position: 60.0 μm - Charge: 8.51 pC - Rise Time: 1.04 ns

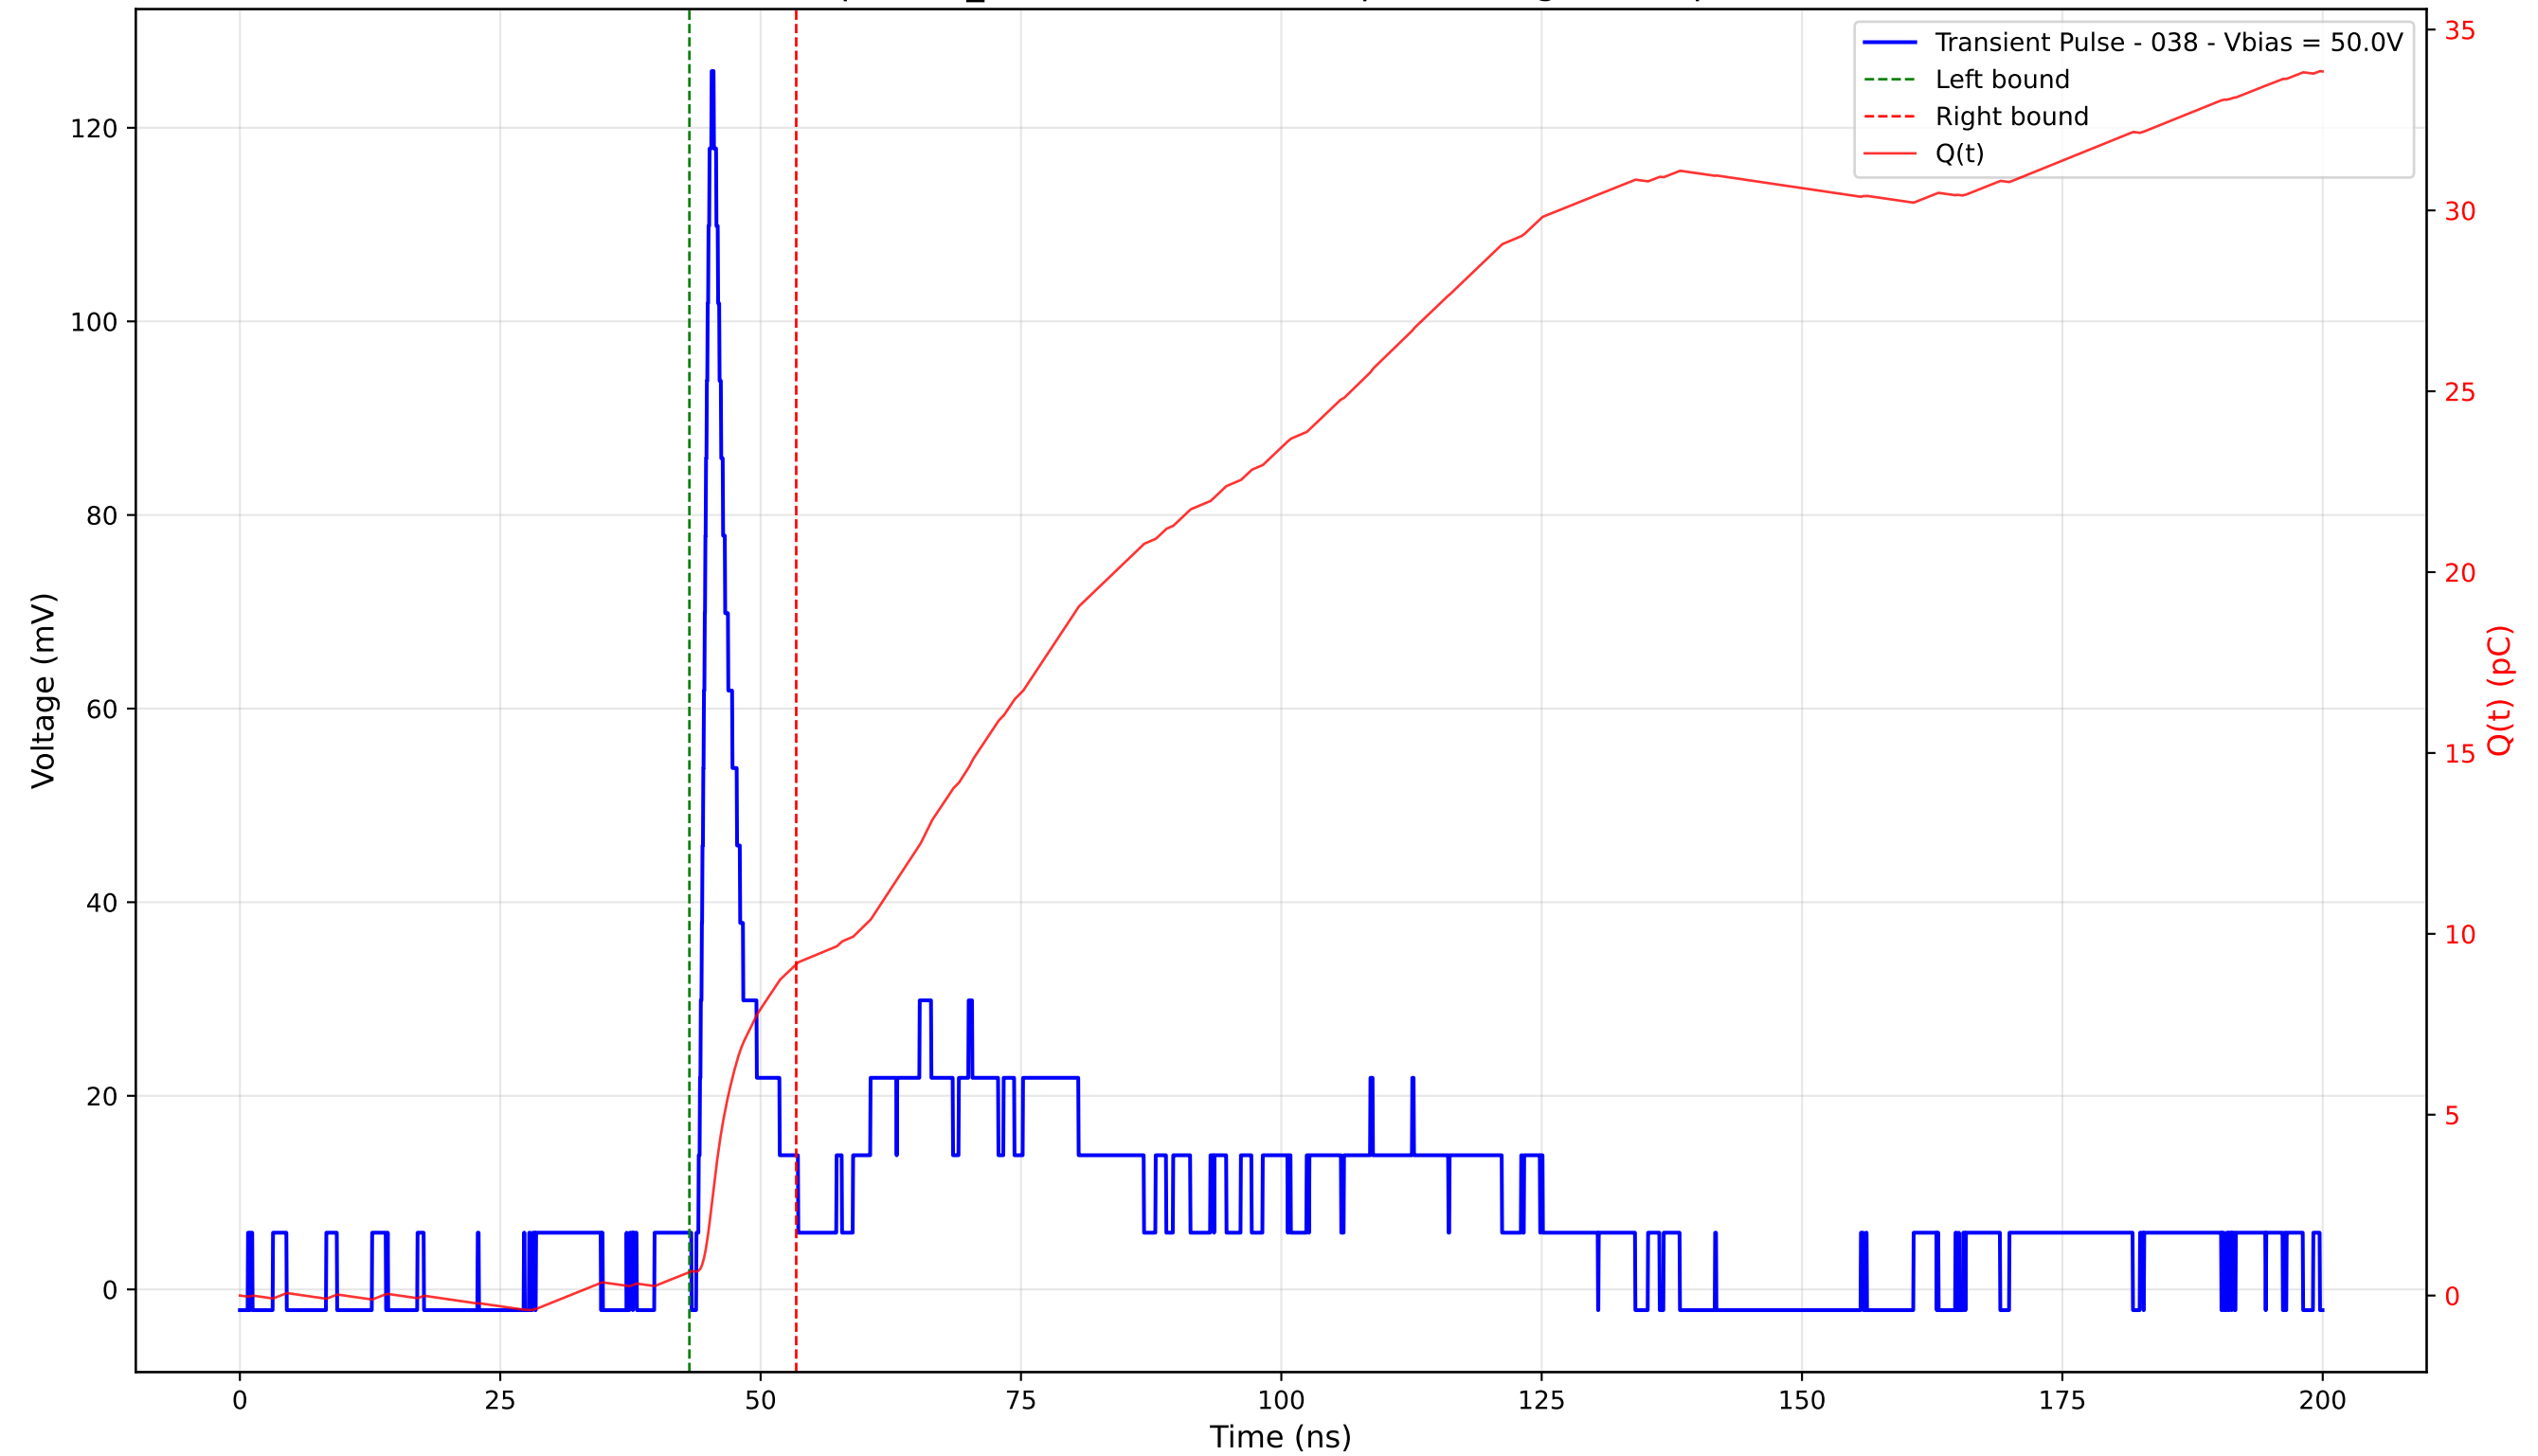


Transient Pulse - Sample: TD_4004 - Position: 65.0 μm - Charge: 13.64 pC - Rise Time: 0.94 ns

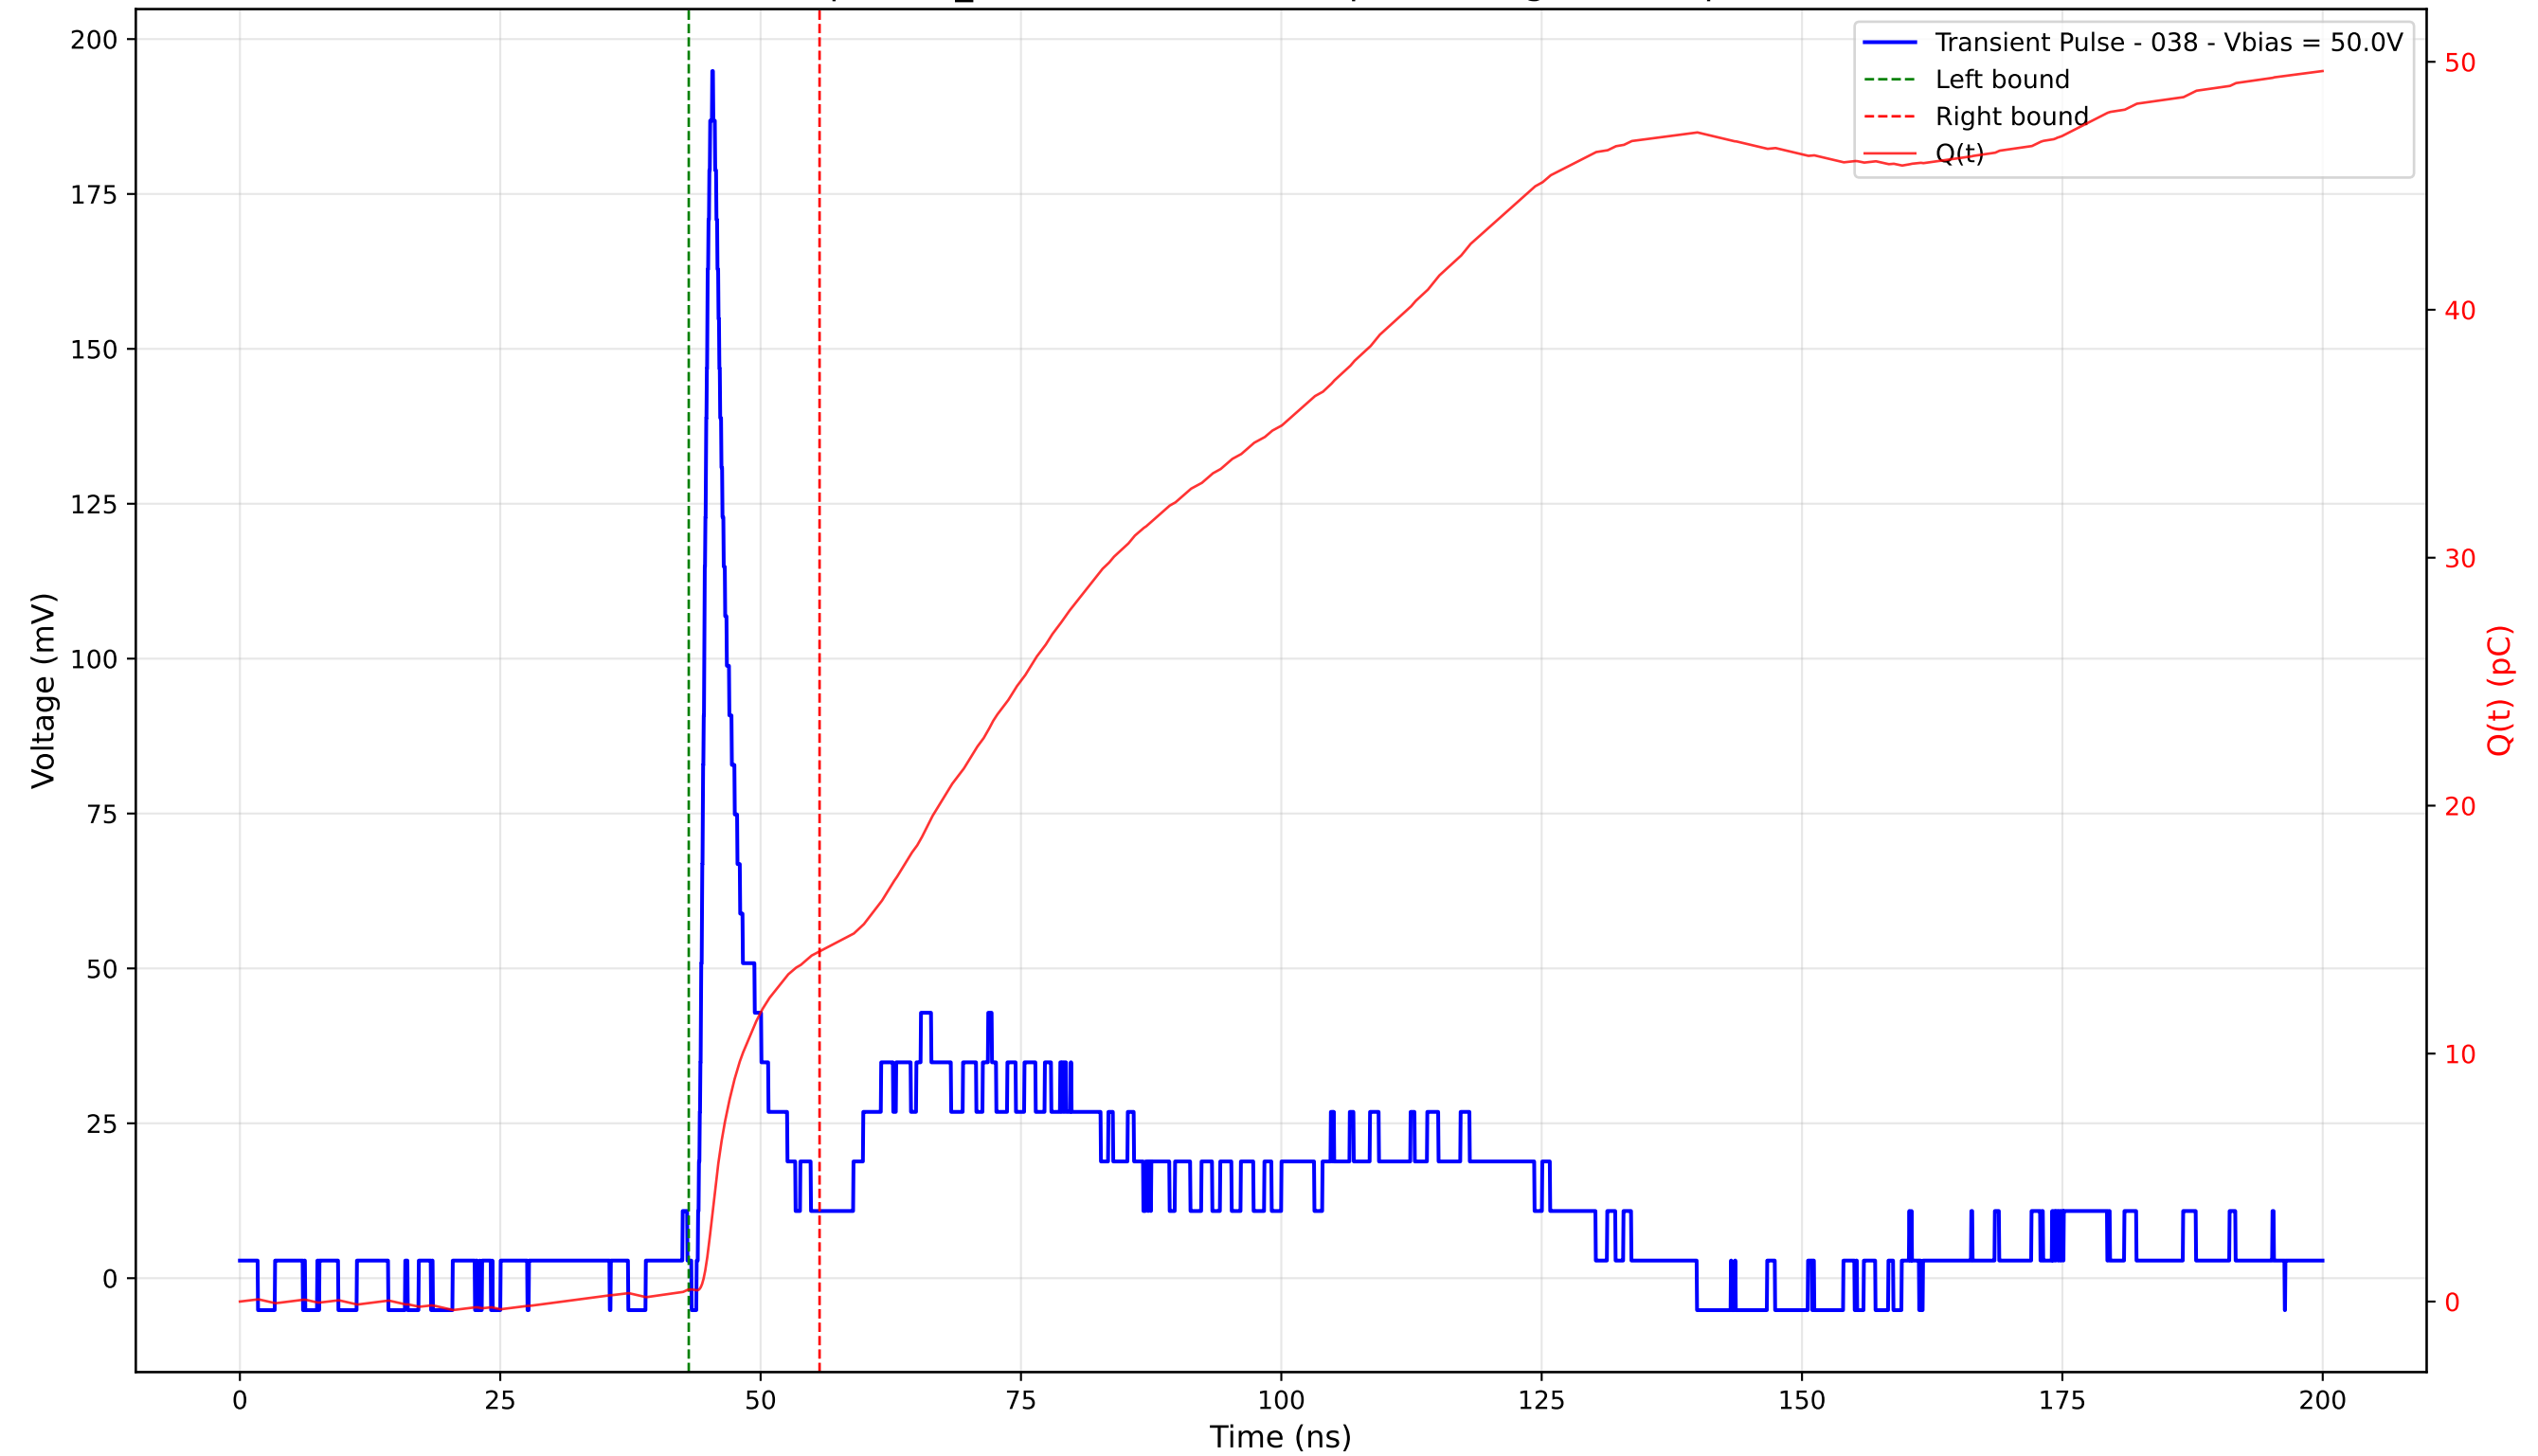


Transient Pulse - Sample: TD_4004 - Position: 70.0 μm - Charge: 74.34 pC - Rise Time: 0.97 ns

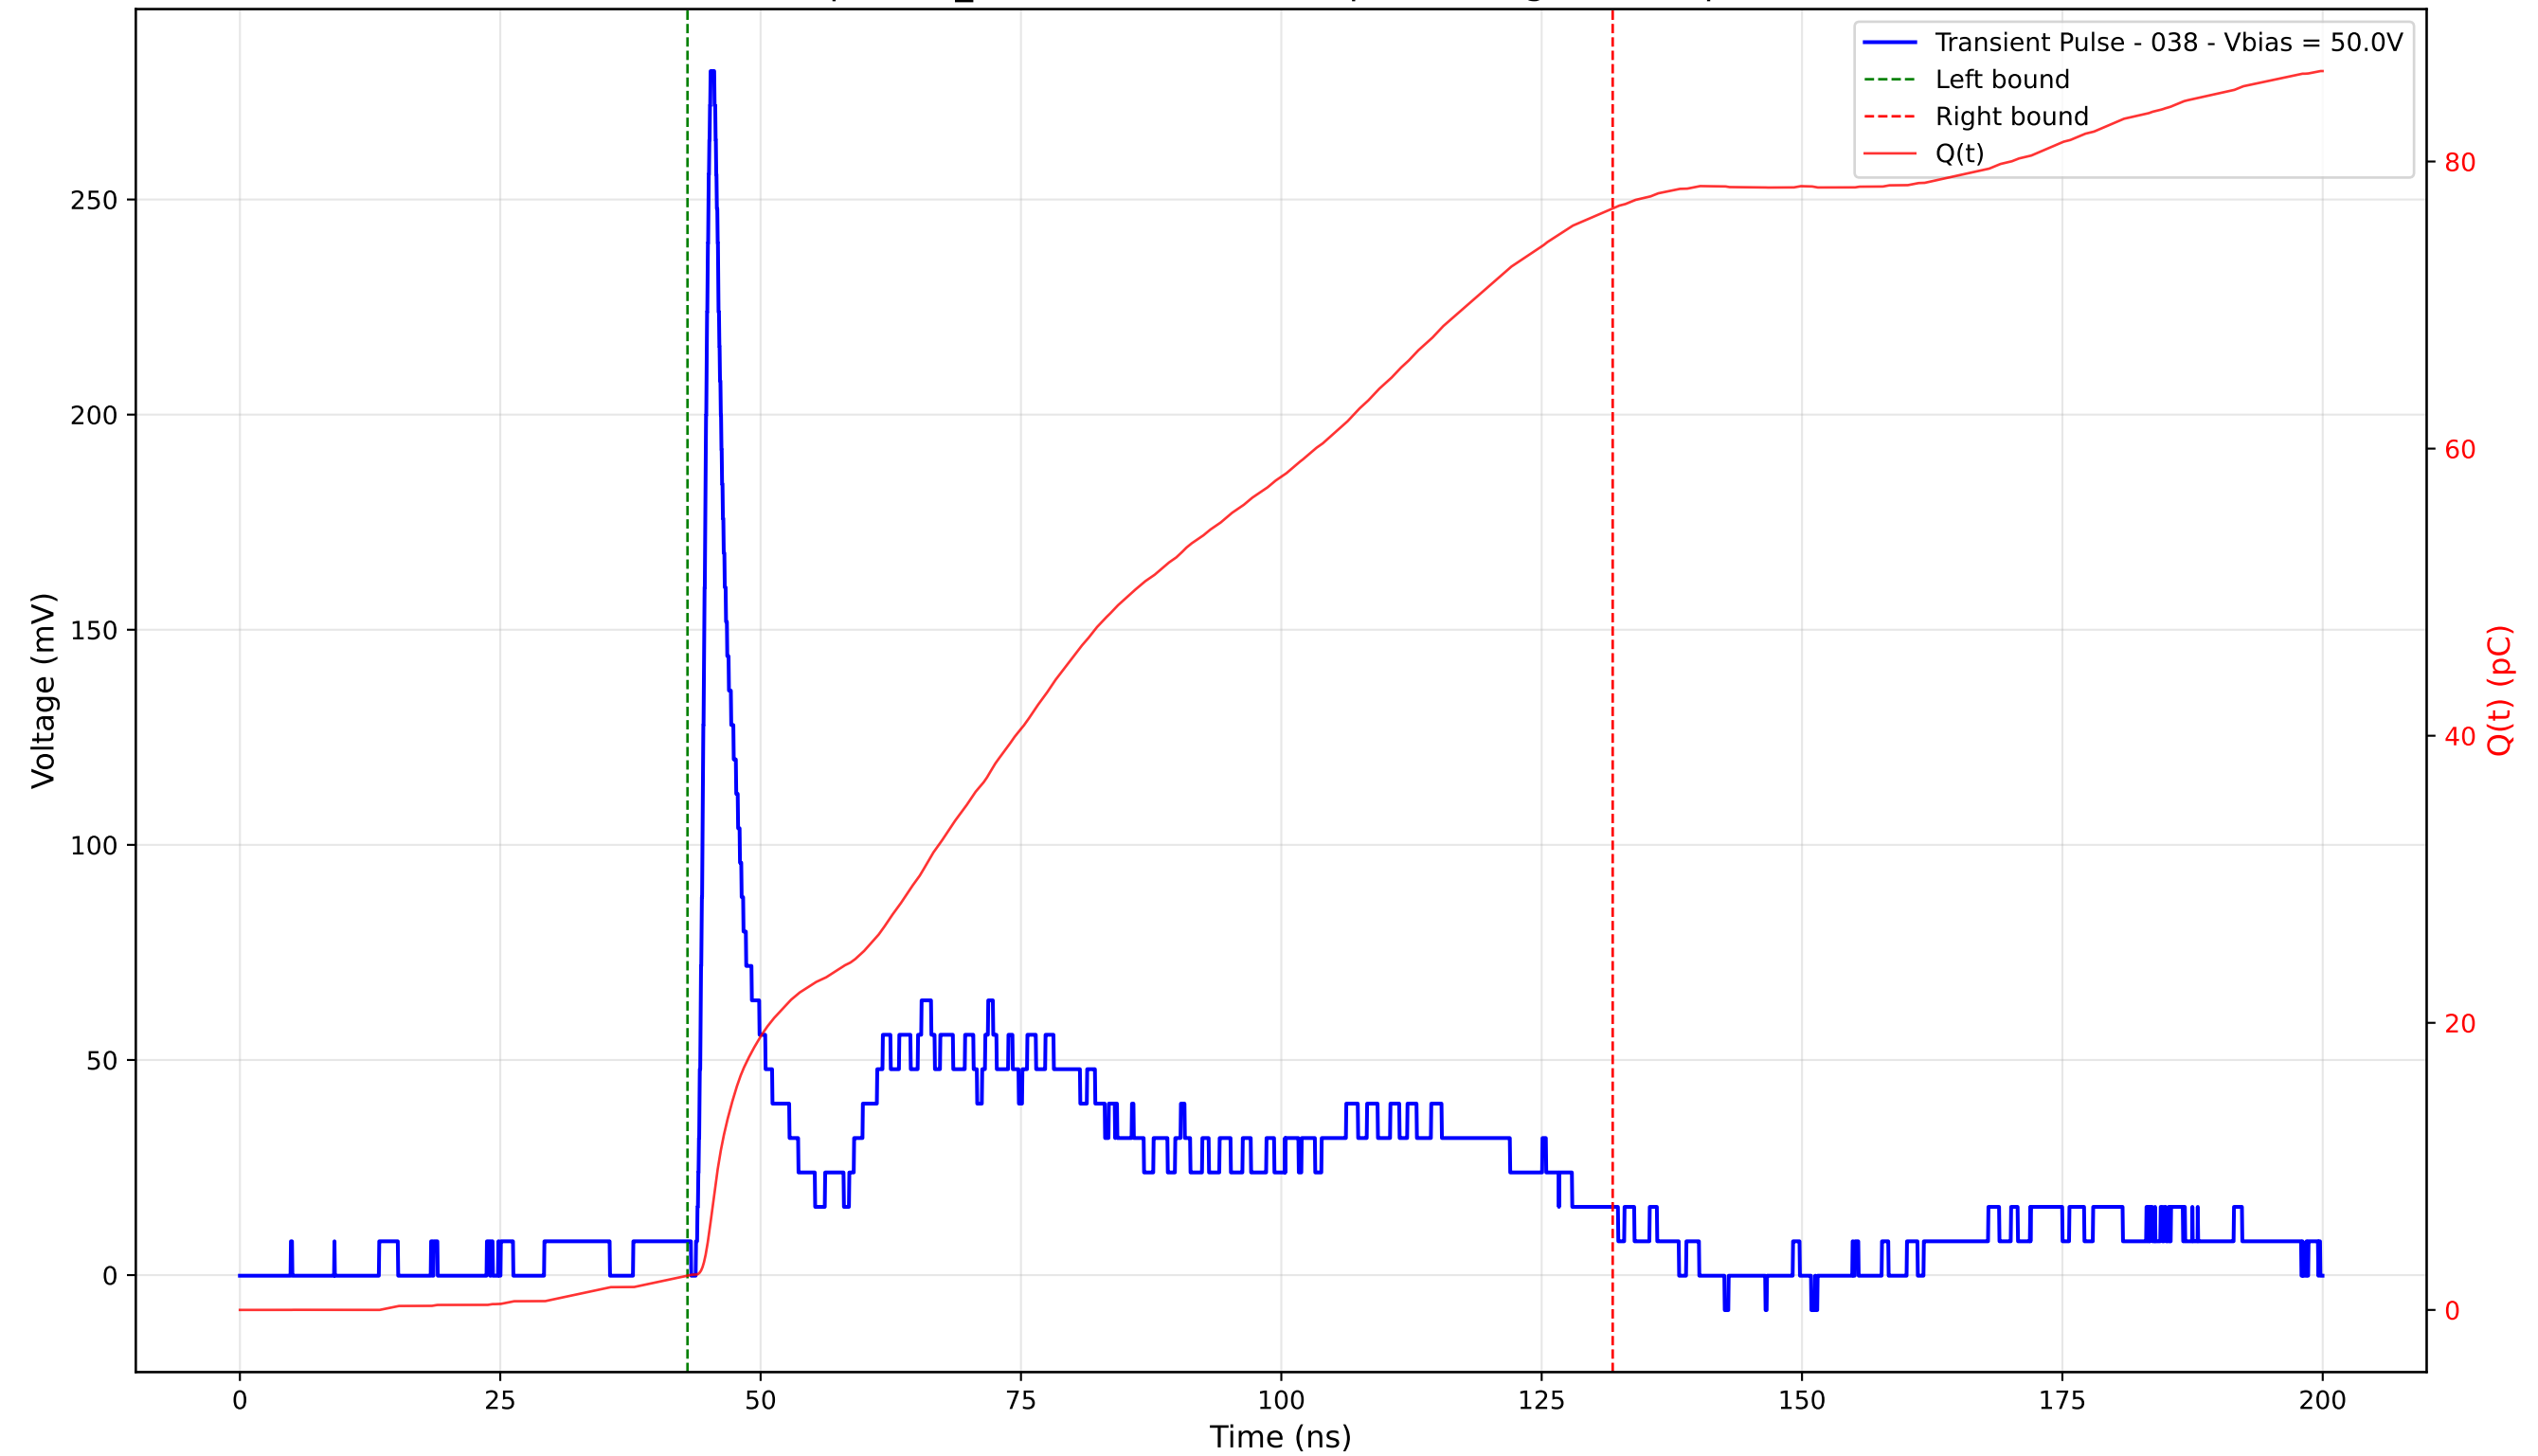


Transient Pulse - Sample: TD_4004 - Position: 75.0 μm - Charge: 25.59 pC - Rise Time: 0.95 ns

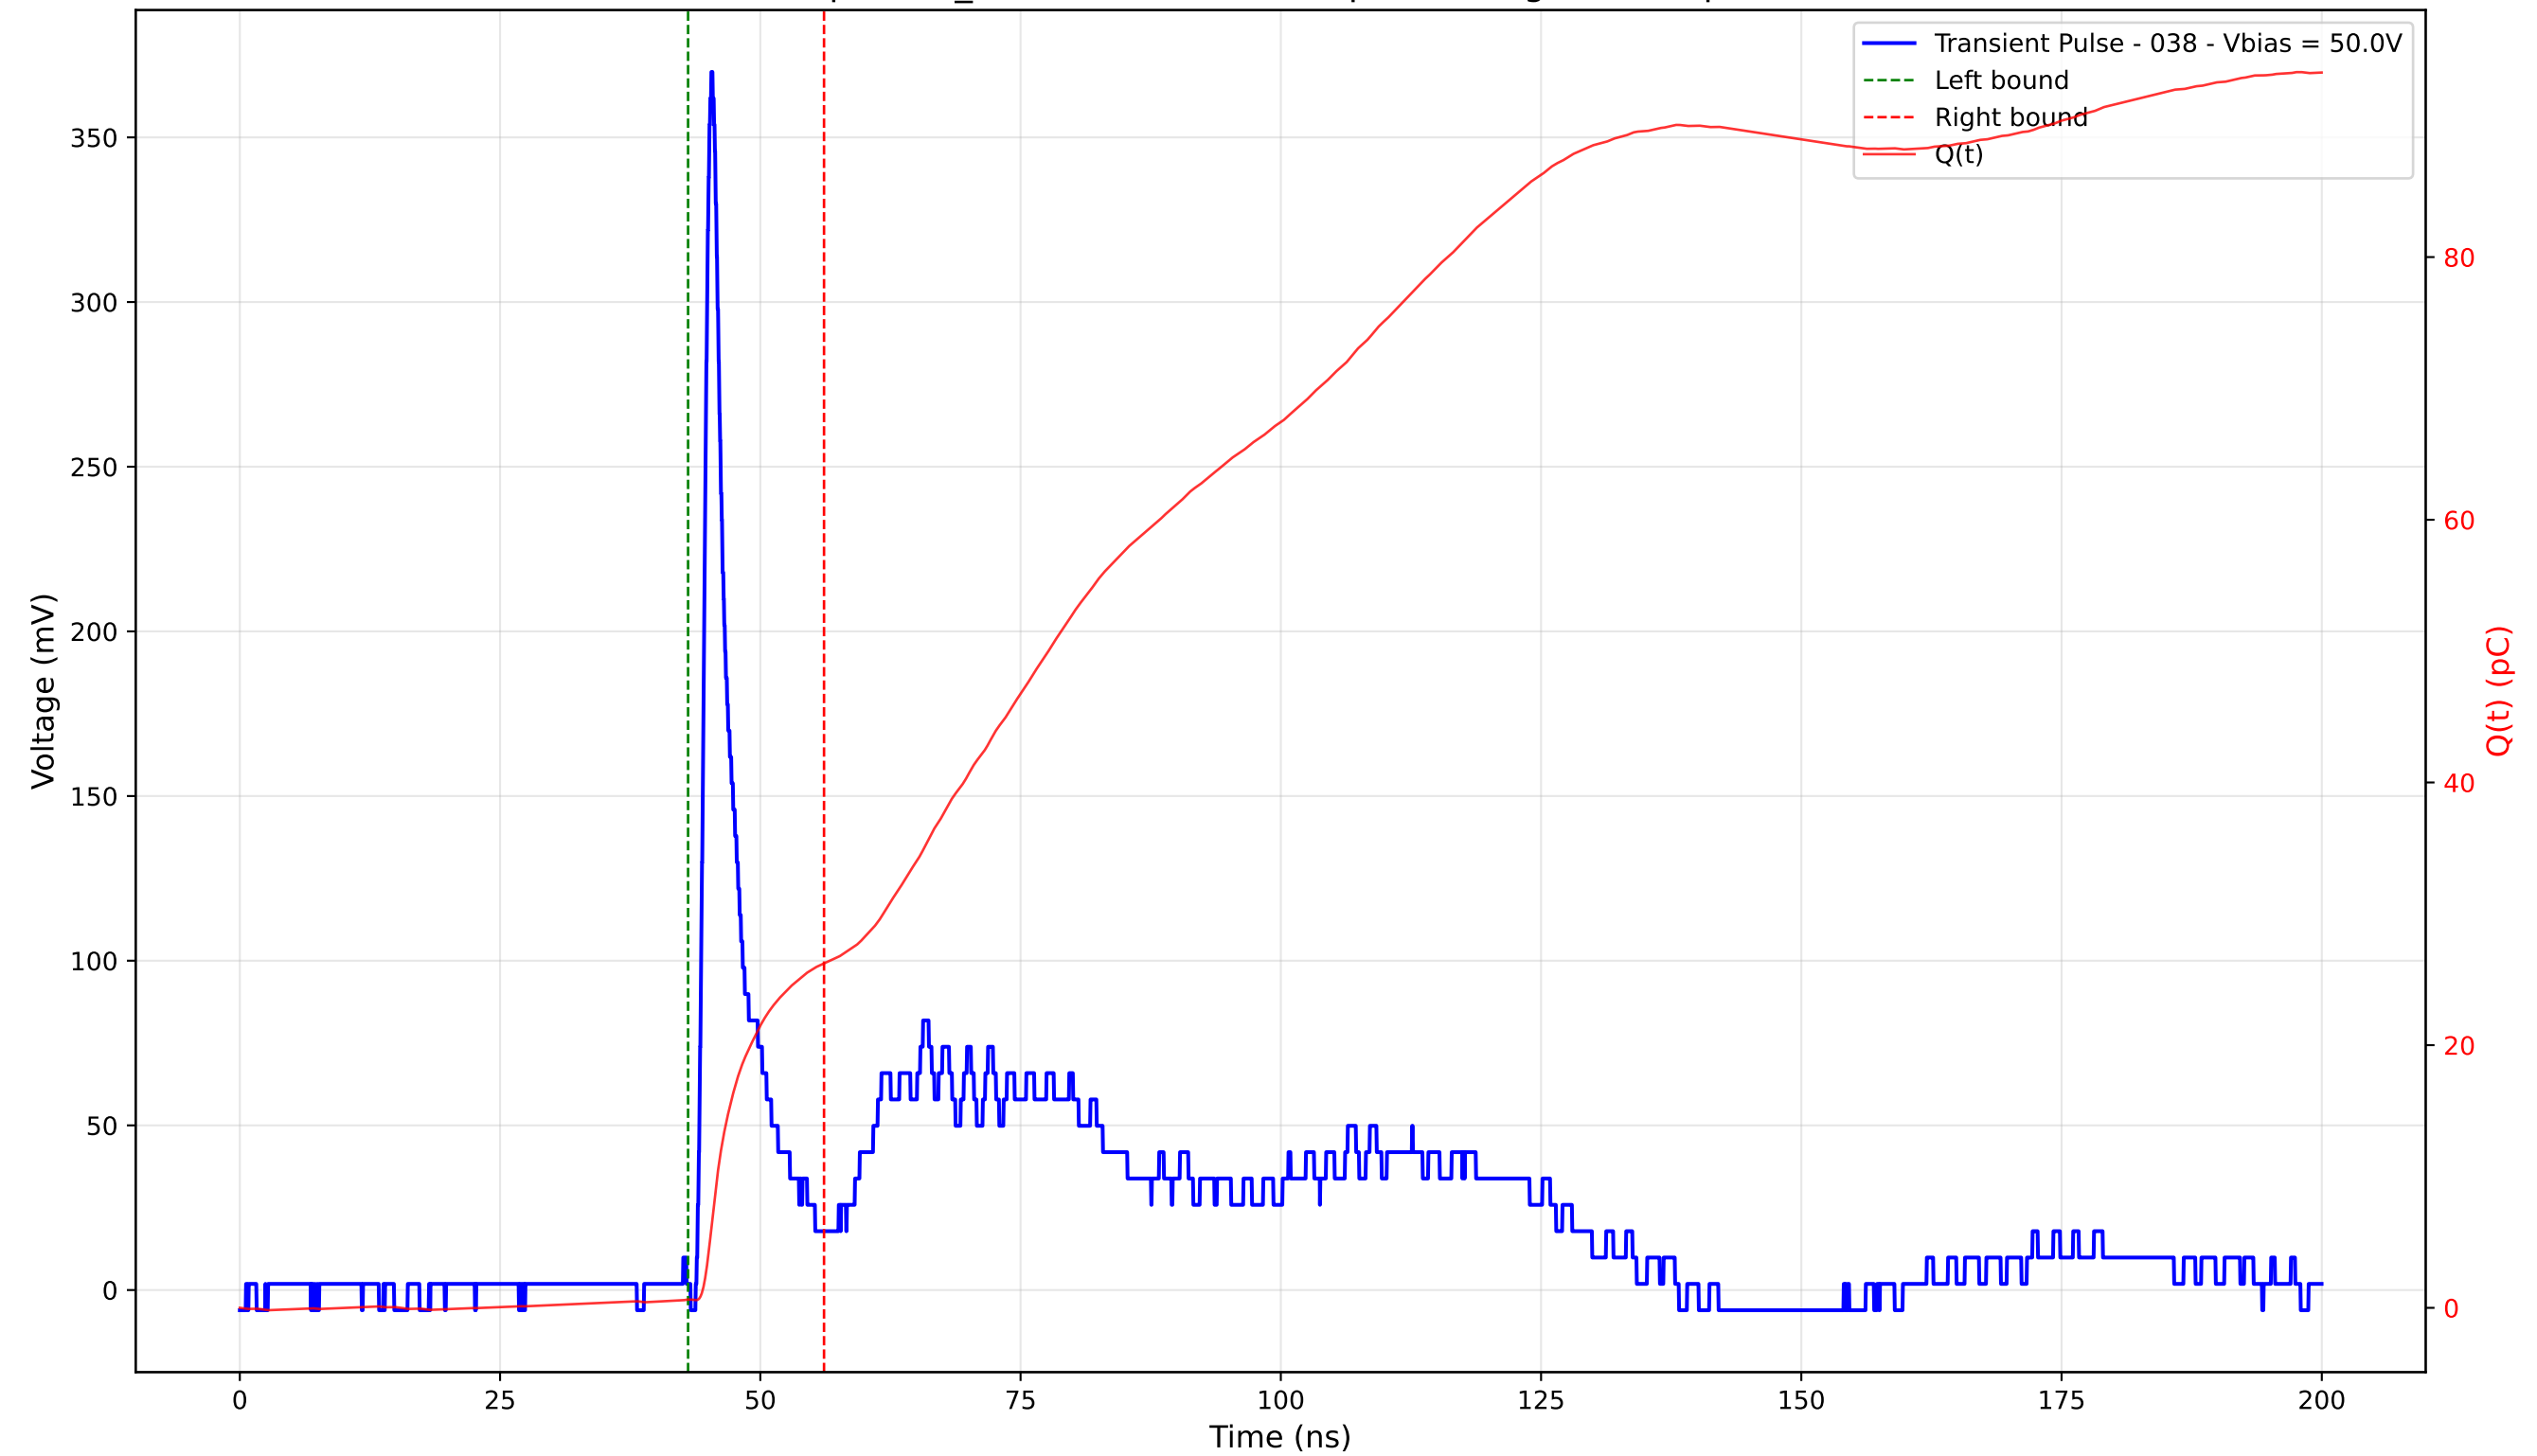


Transient Pulse - Sample: TD_4004 - Position: 80.0 μm - Charge: 29.49 pC - Rise Time: 0.92 ns

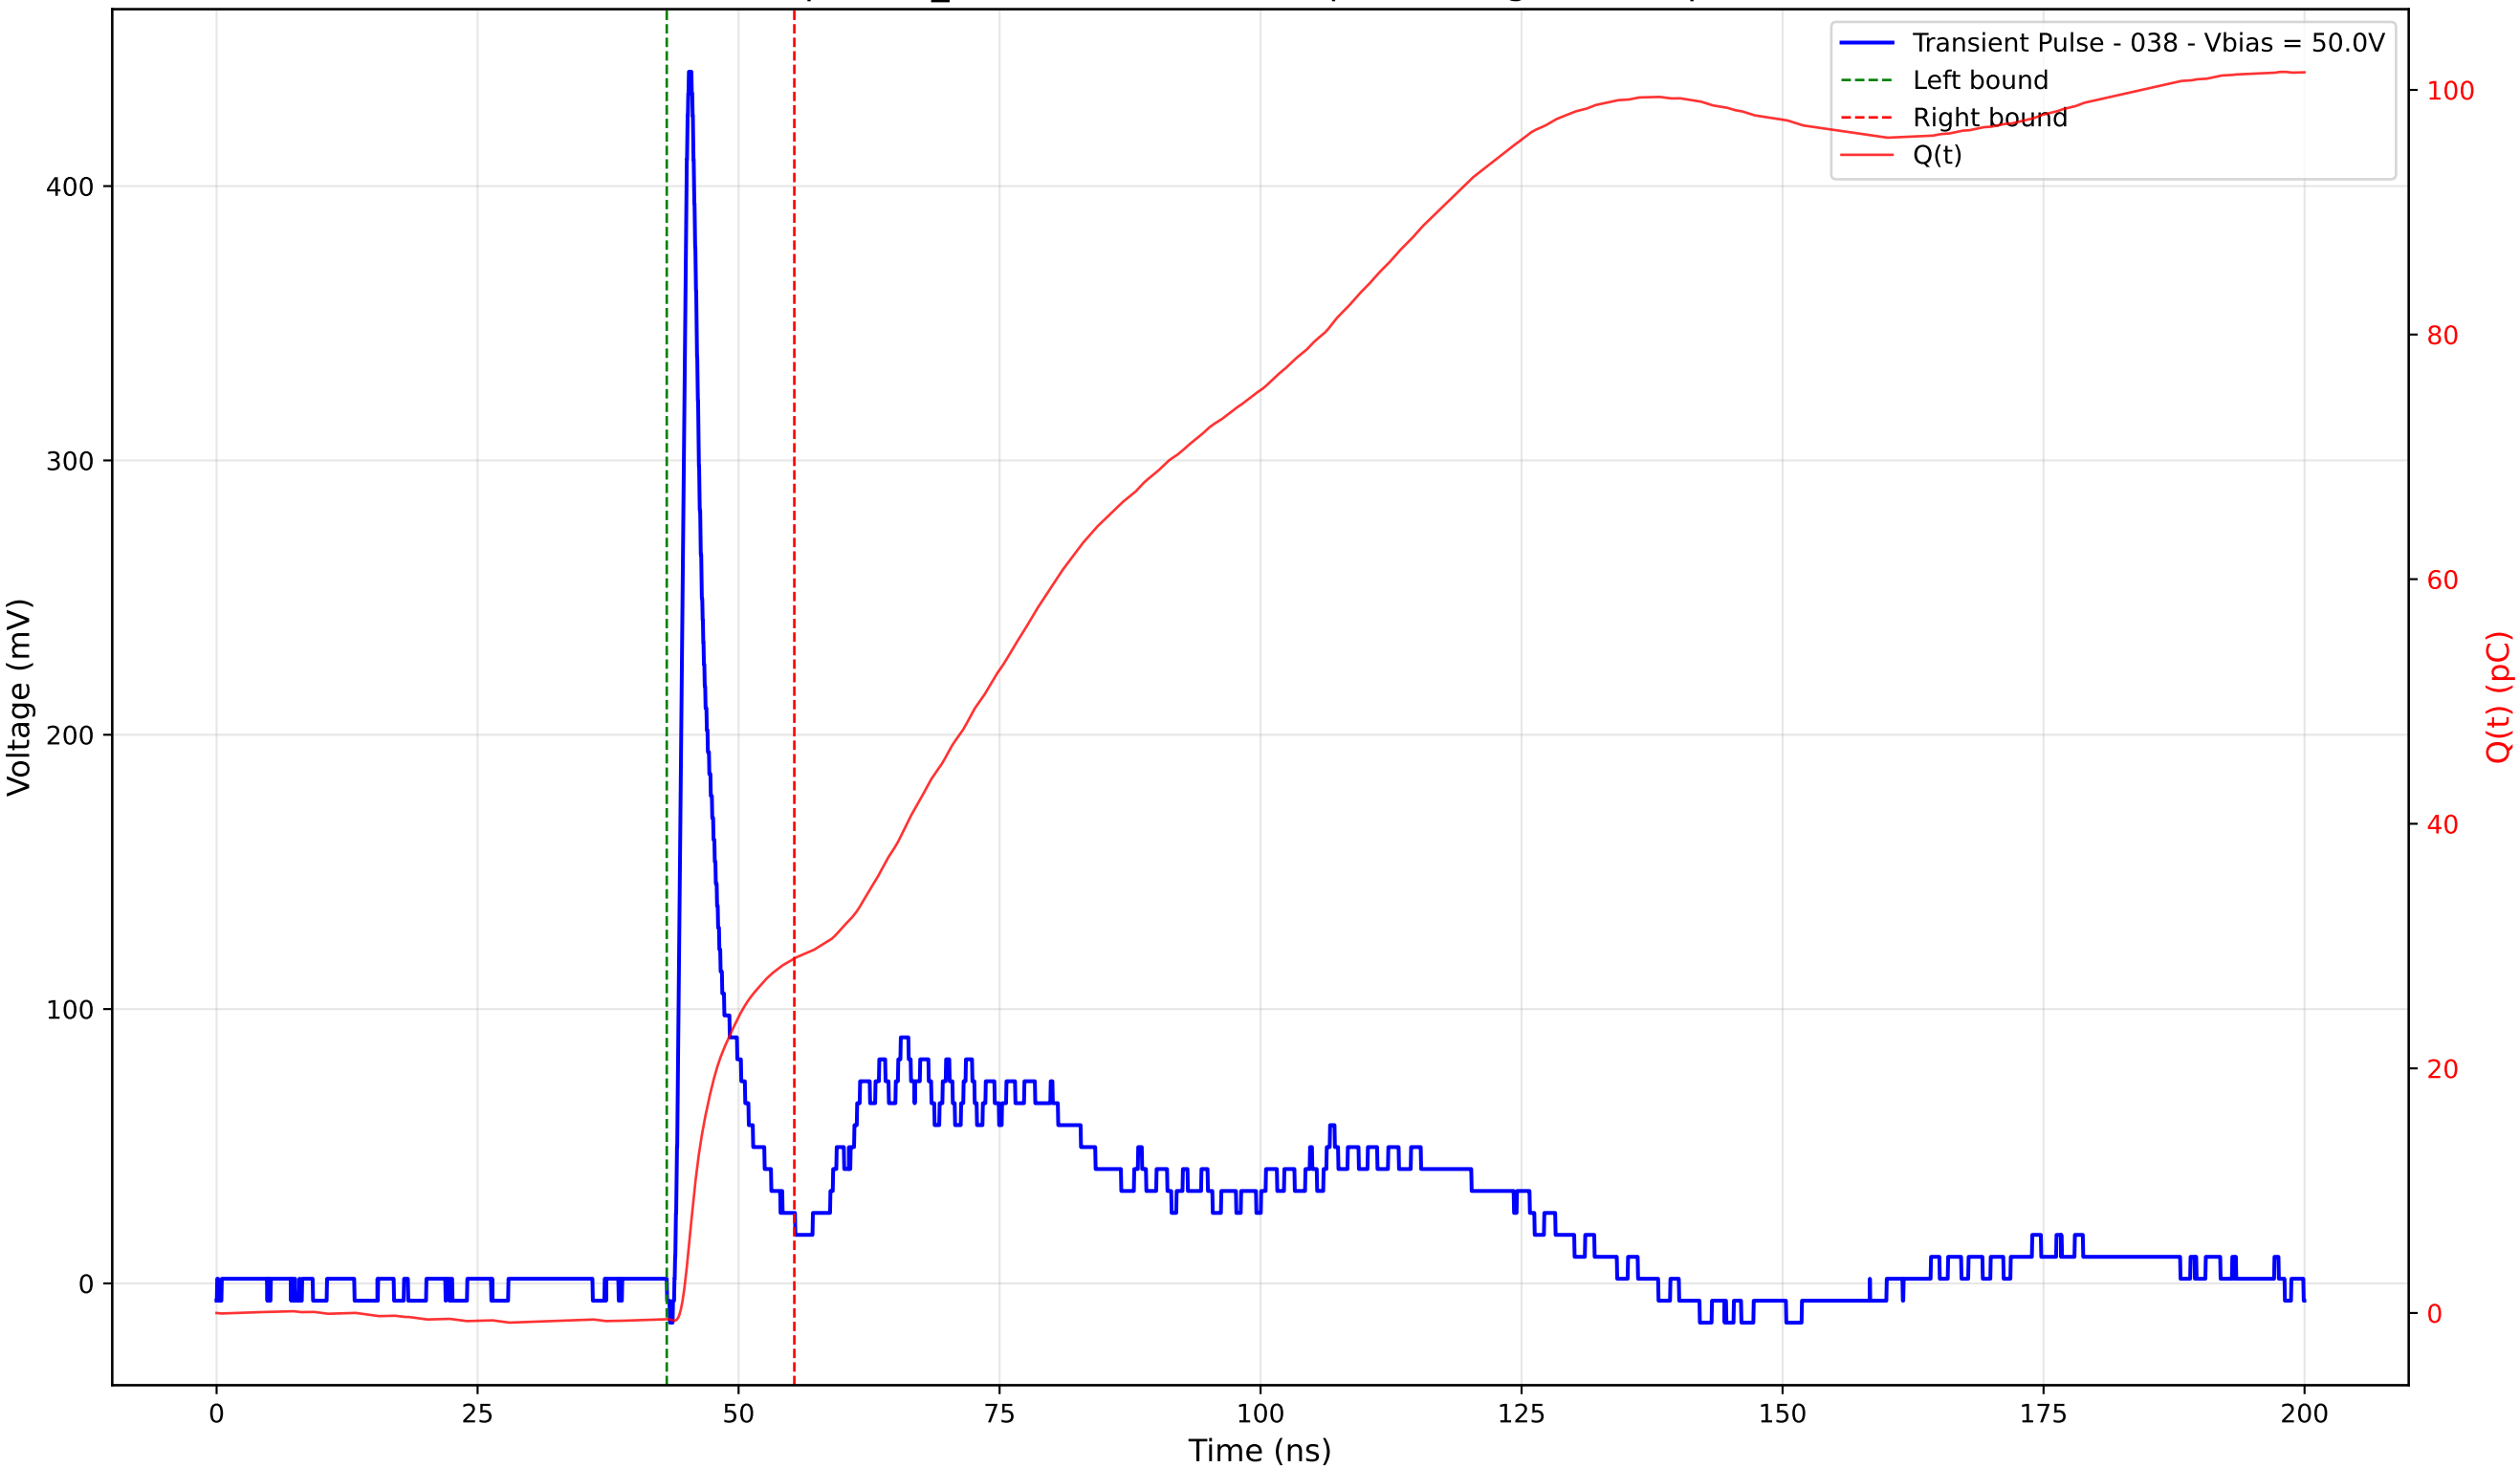


Transient Pulse - Sample: TD_4004 - Position: 85.0 μm - Charge: 114.43 pC - Rise Time: 0.94 ns

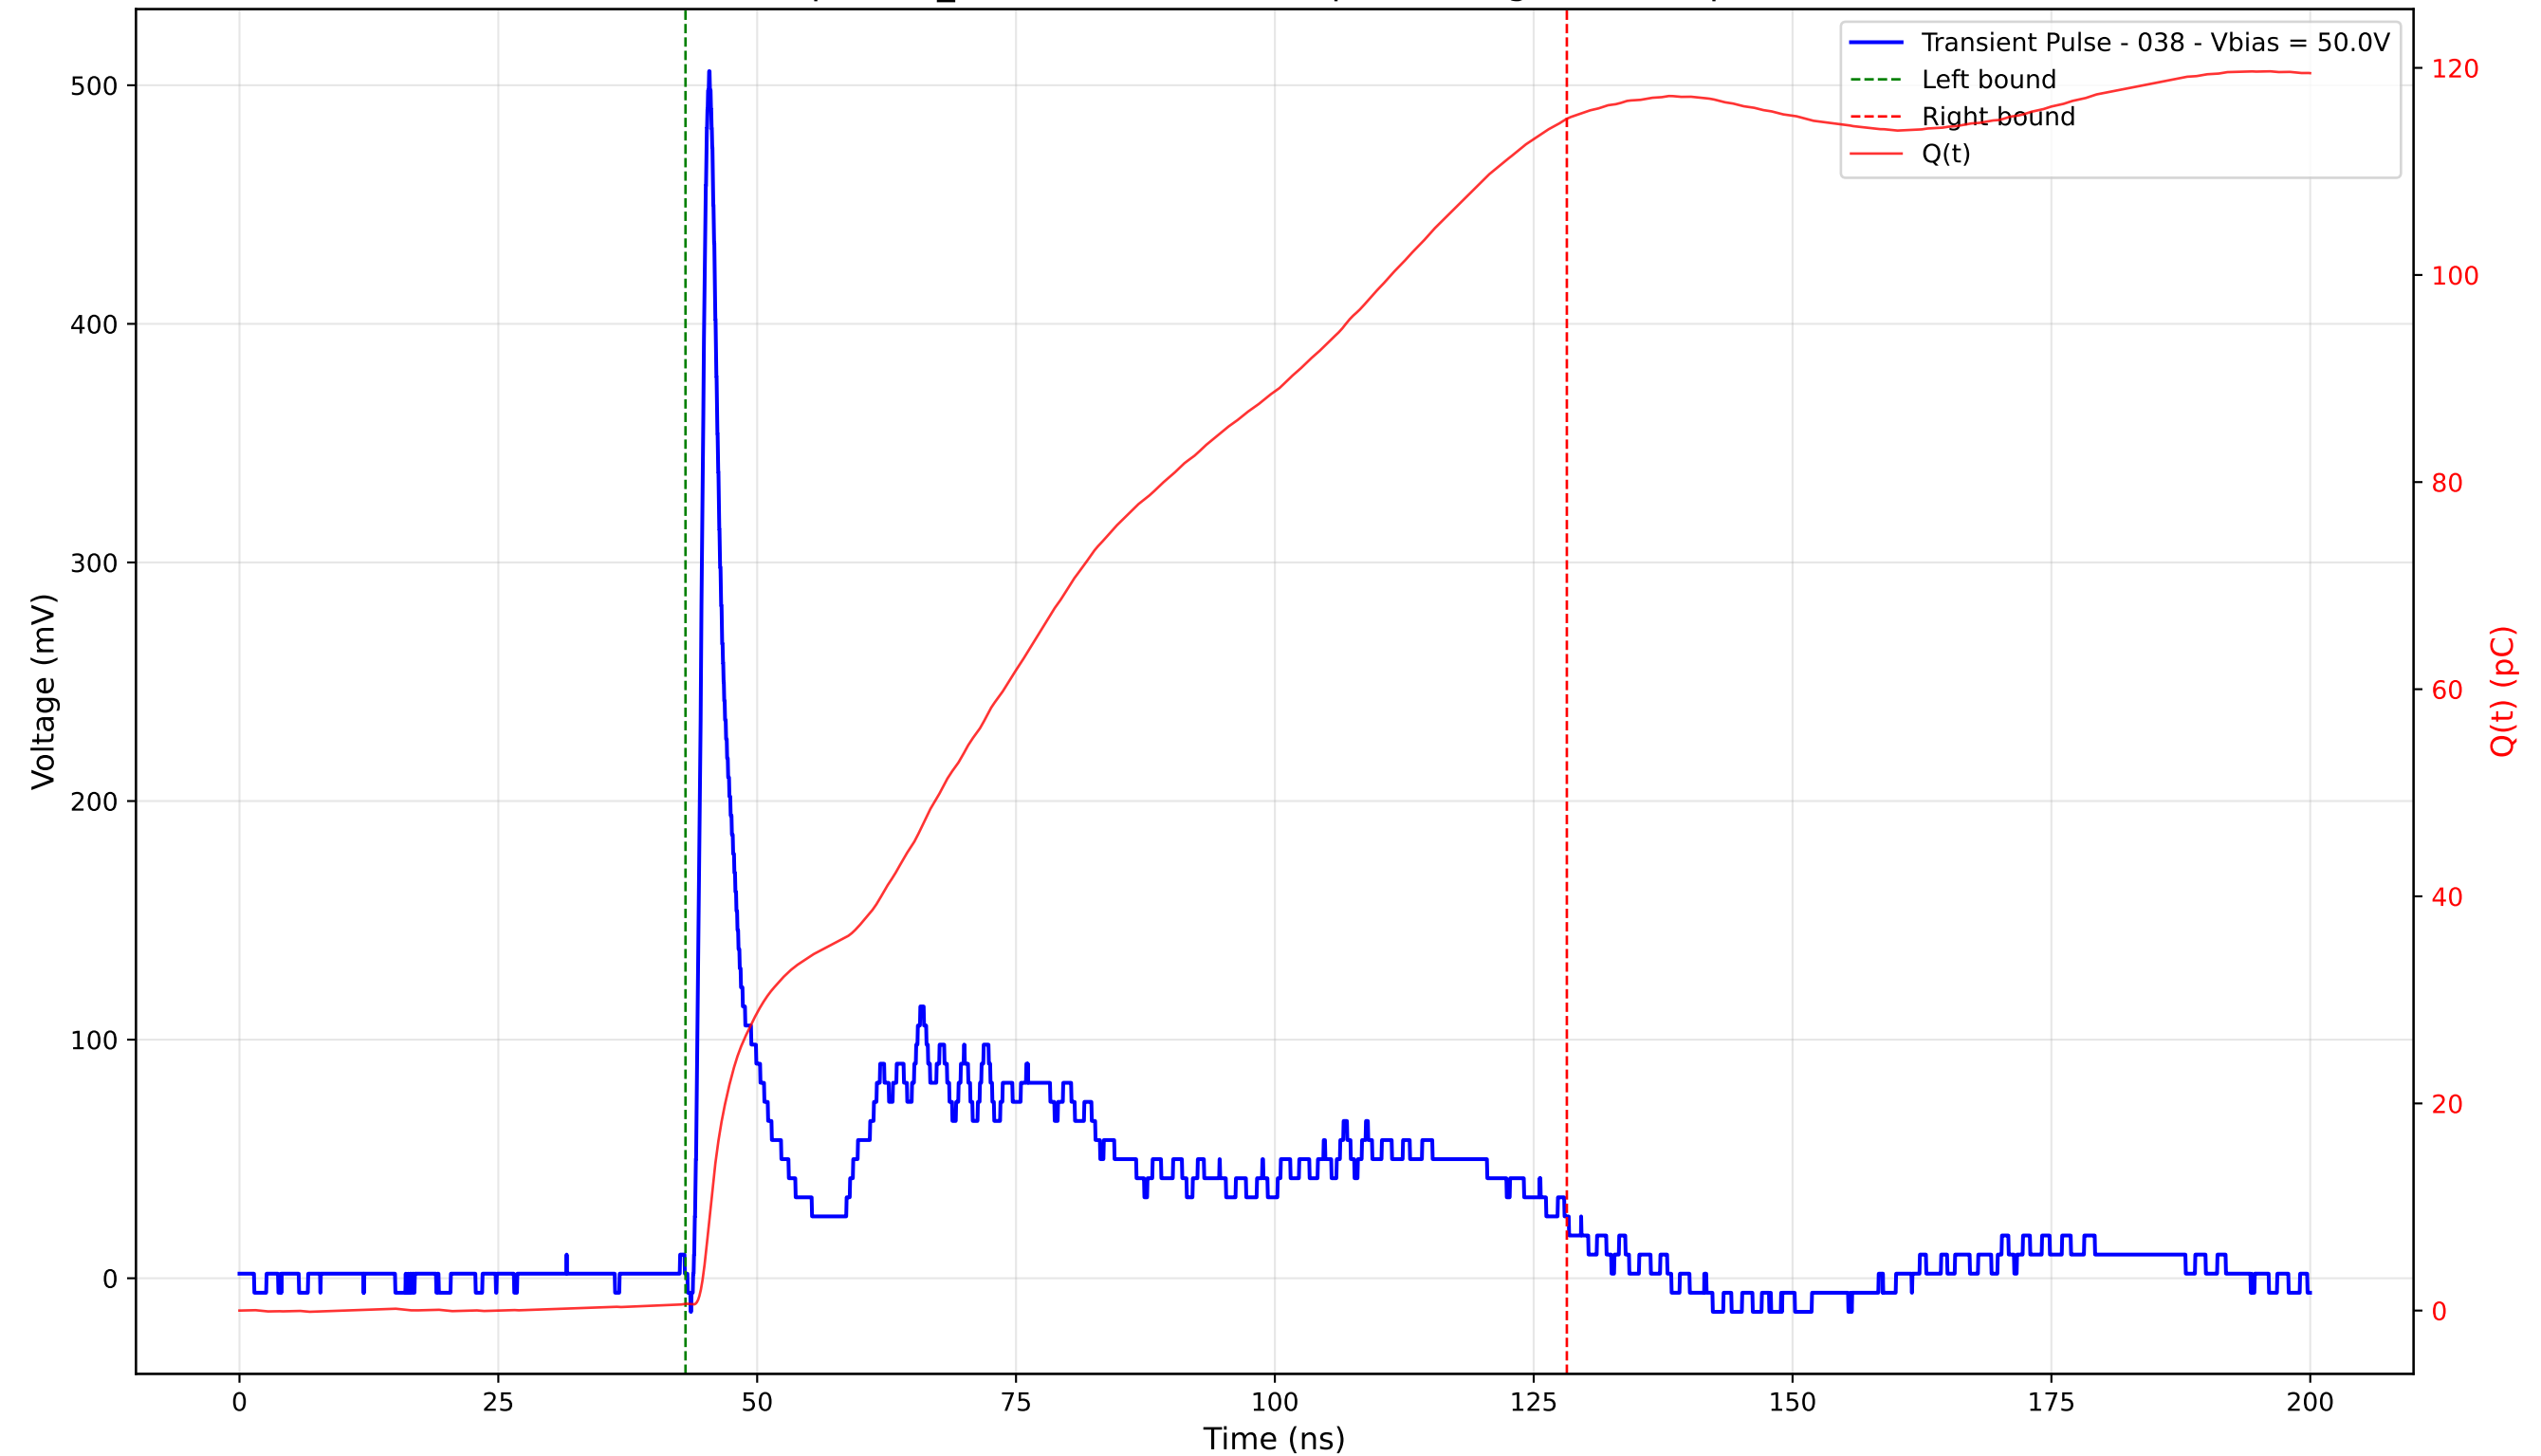


Transient Pulse - Sample: TD_4004 - Position: 90.0 μm - Charge: 126.06 pC - Rise Time: 0.93 ns

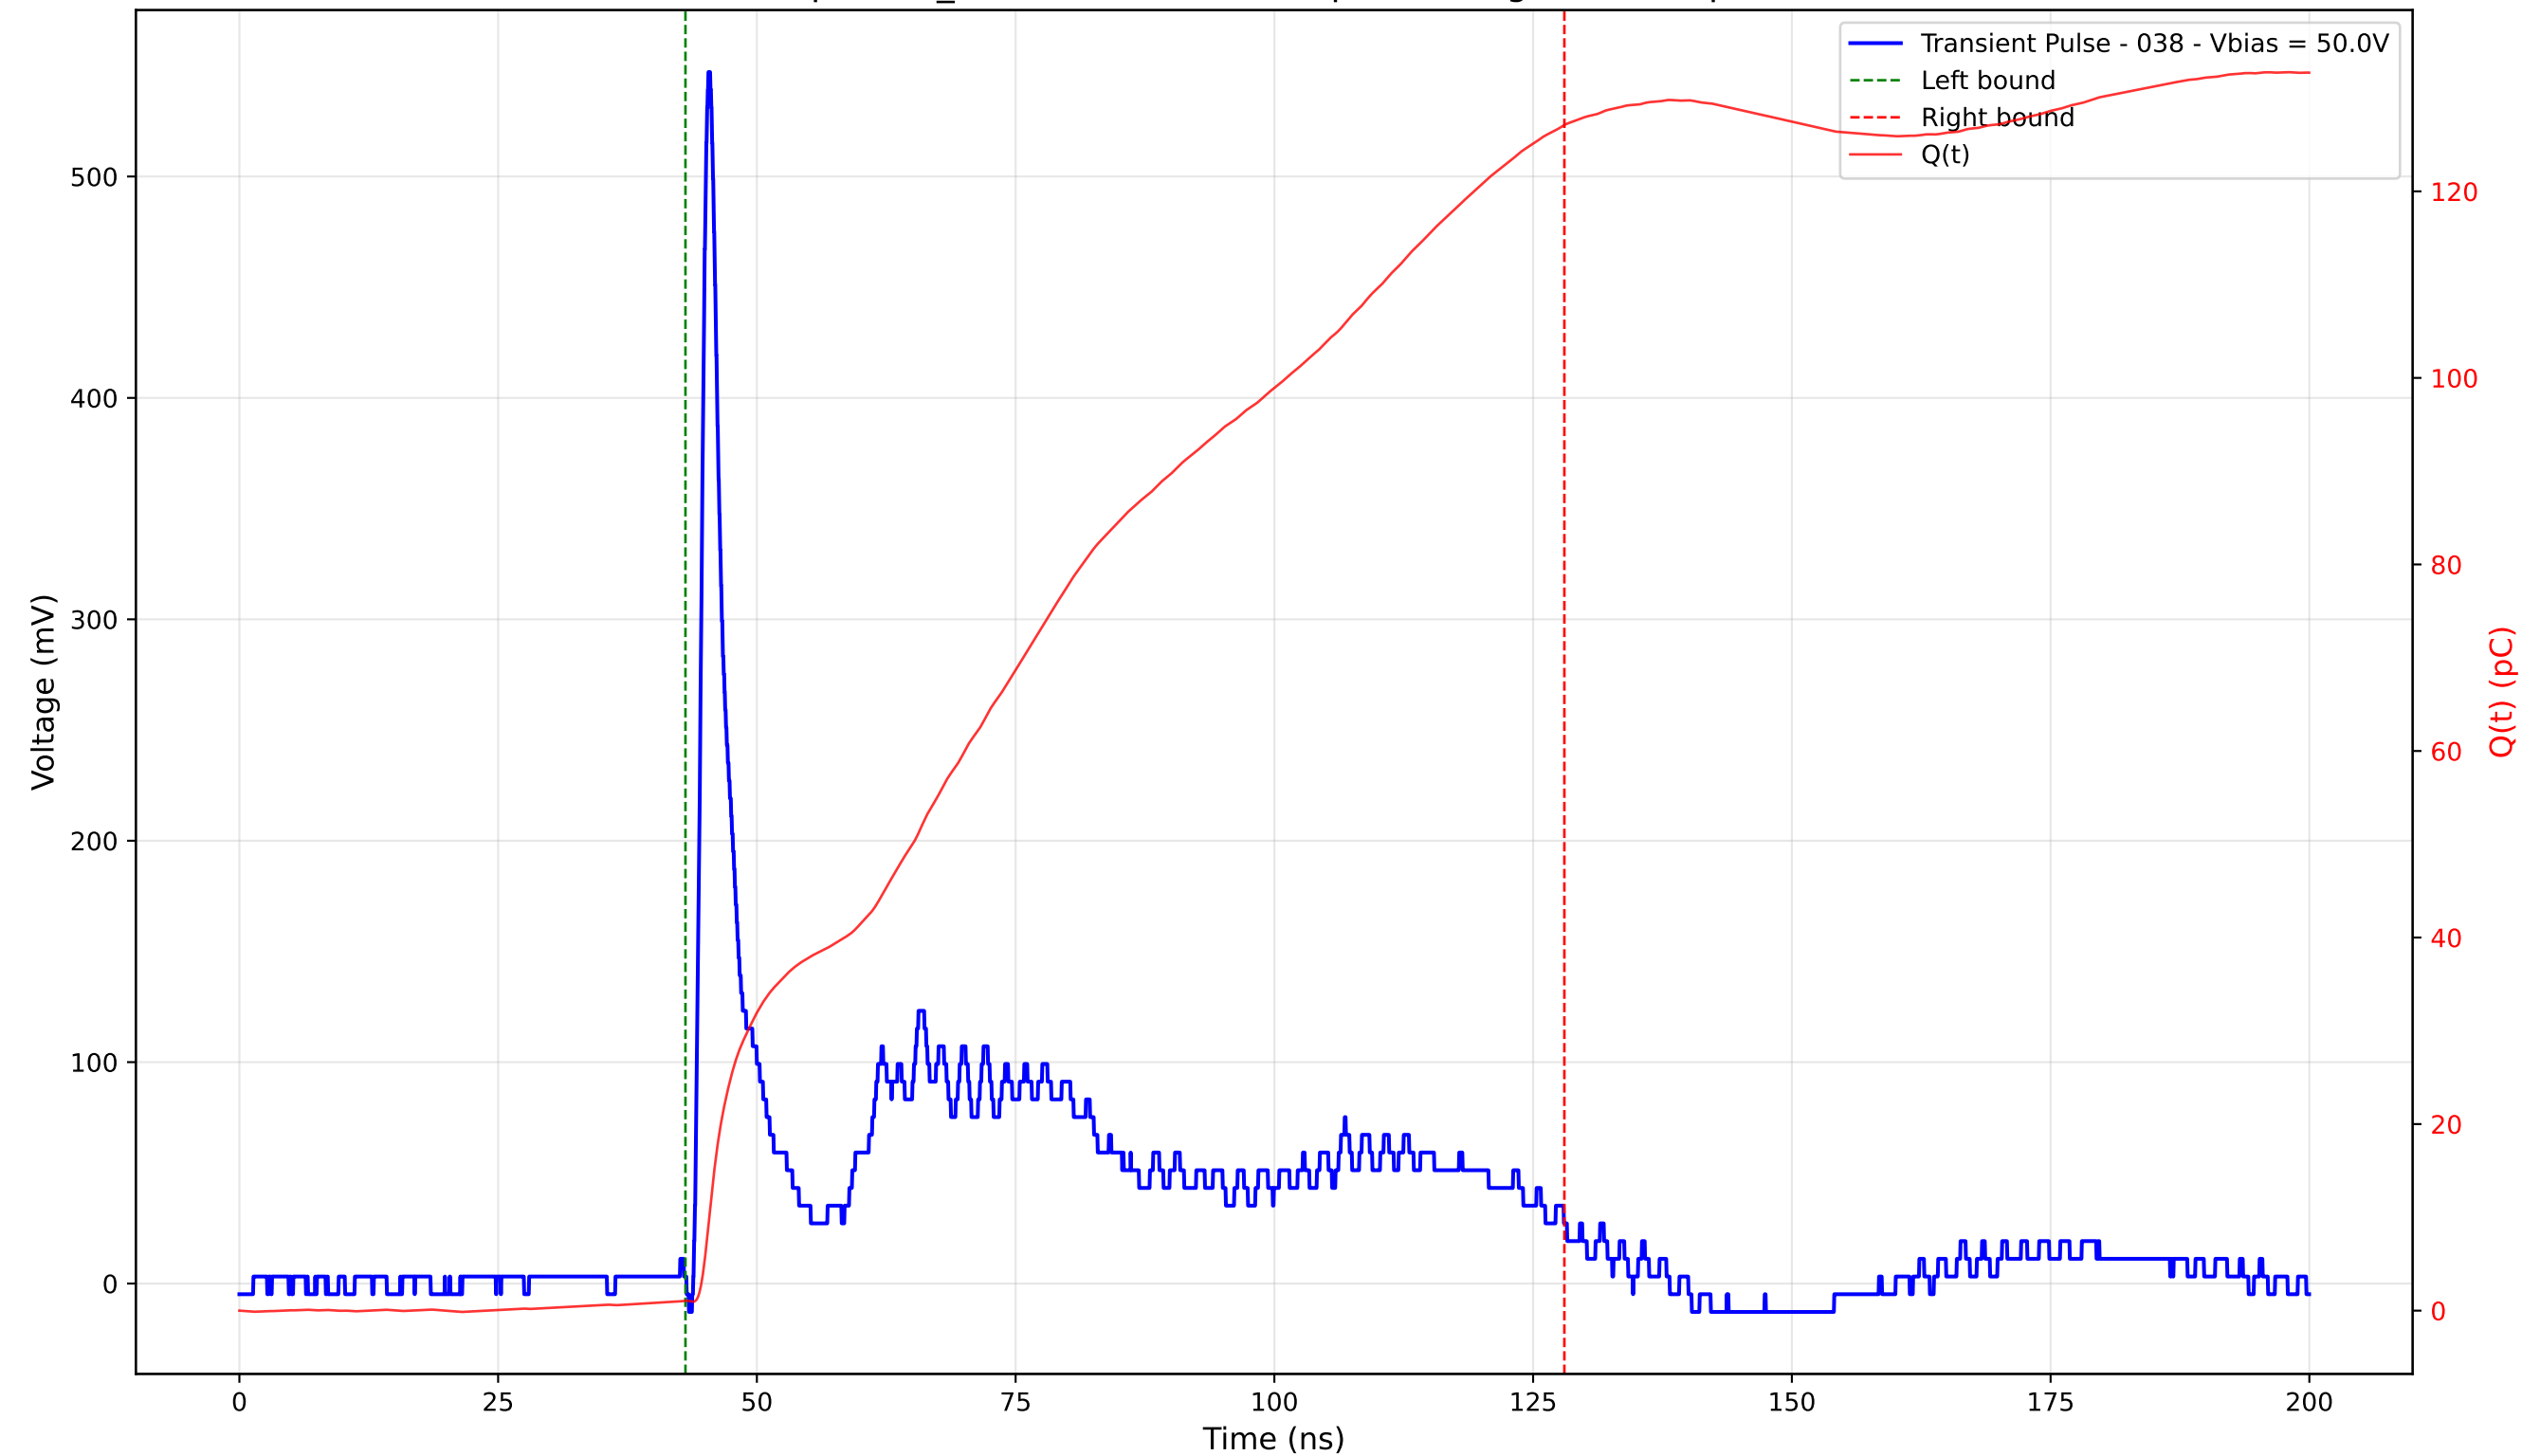


Transient Pulse - Sample: TD_4004 - Position: 95.0 μm - Charge: 142.14 pC - Rise Time: 0.97 ns

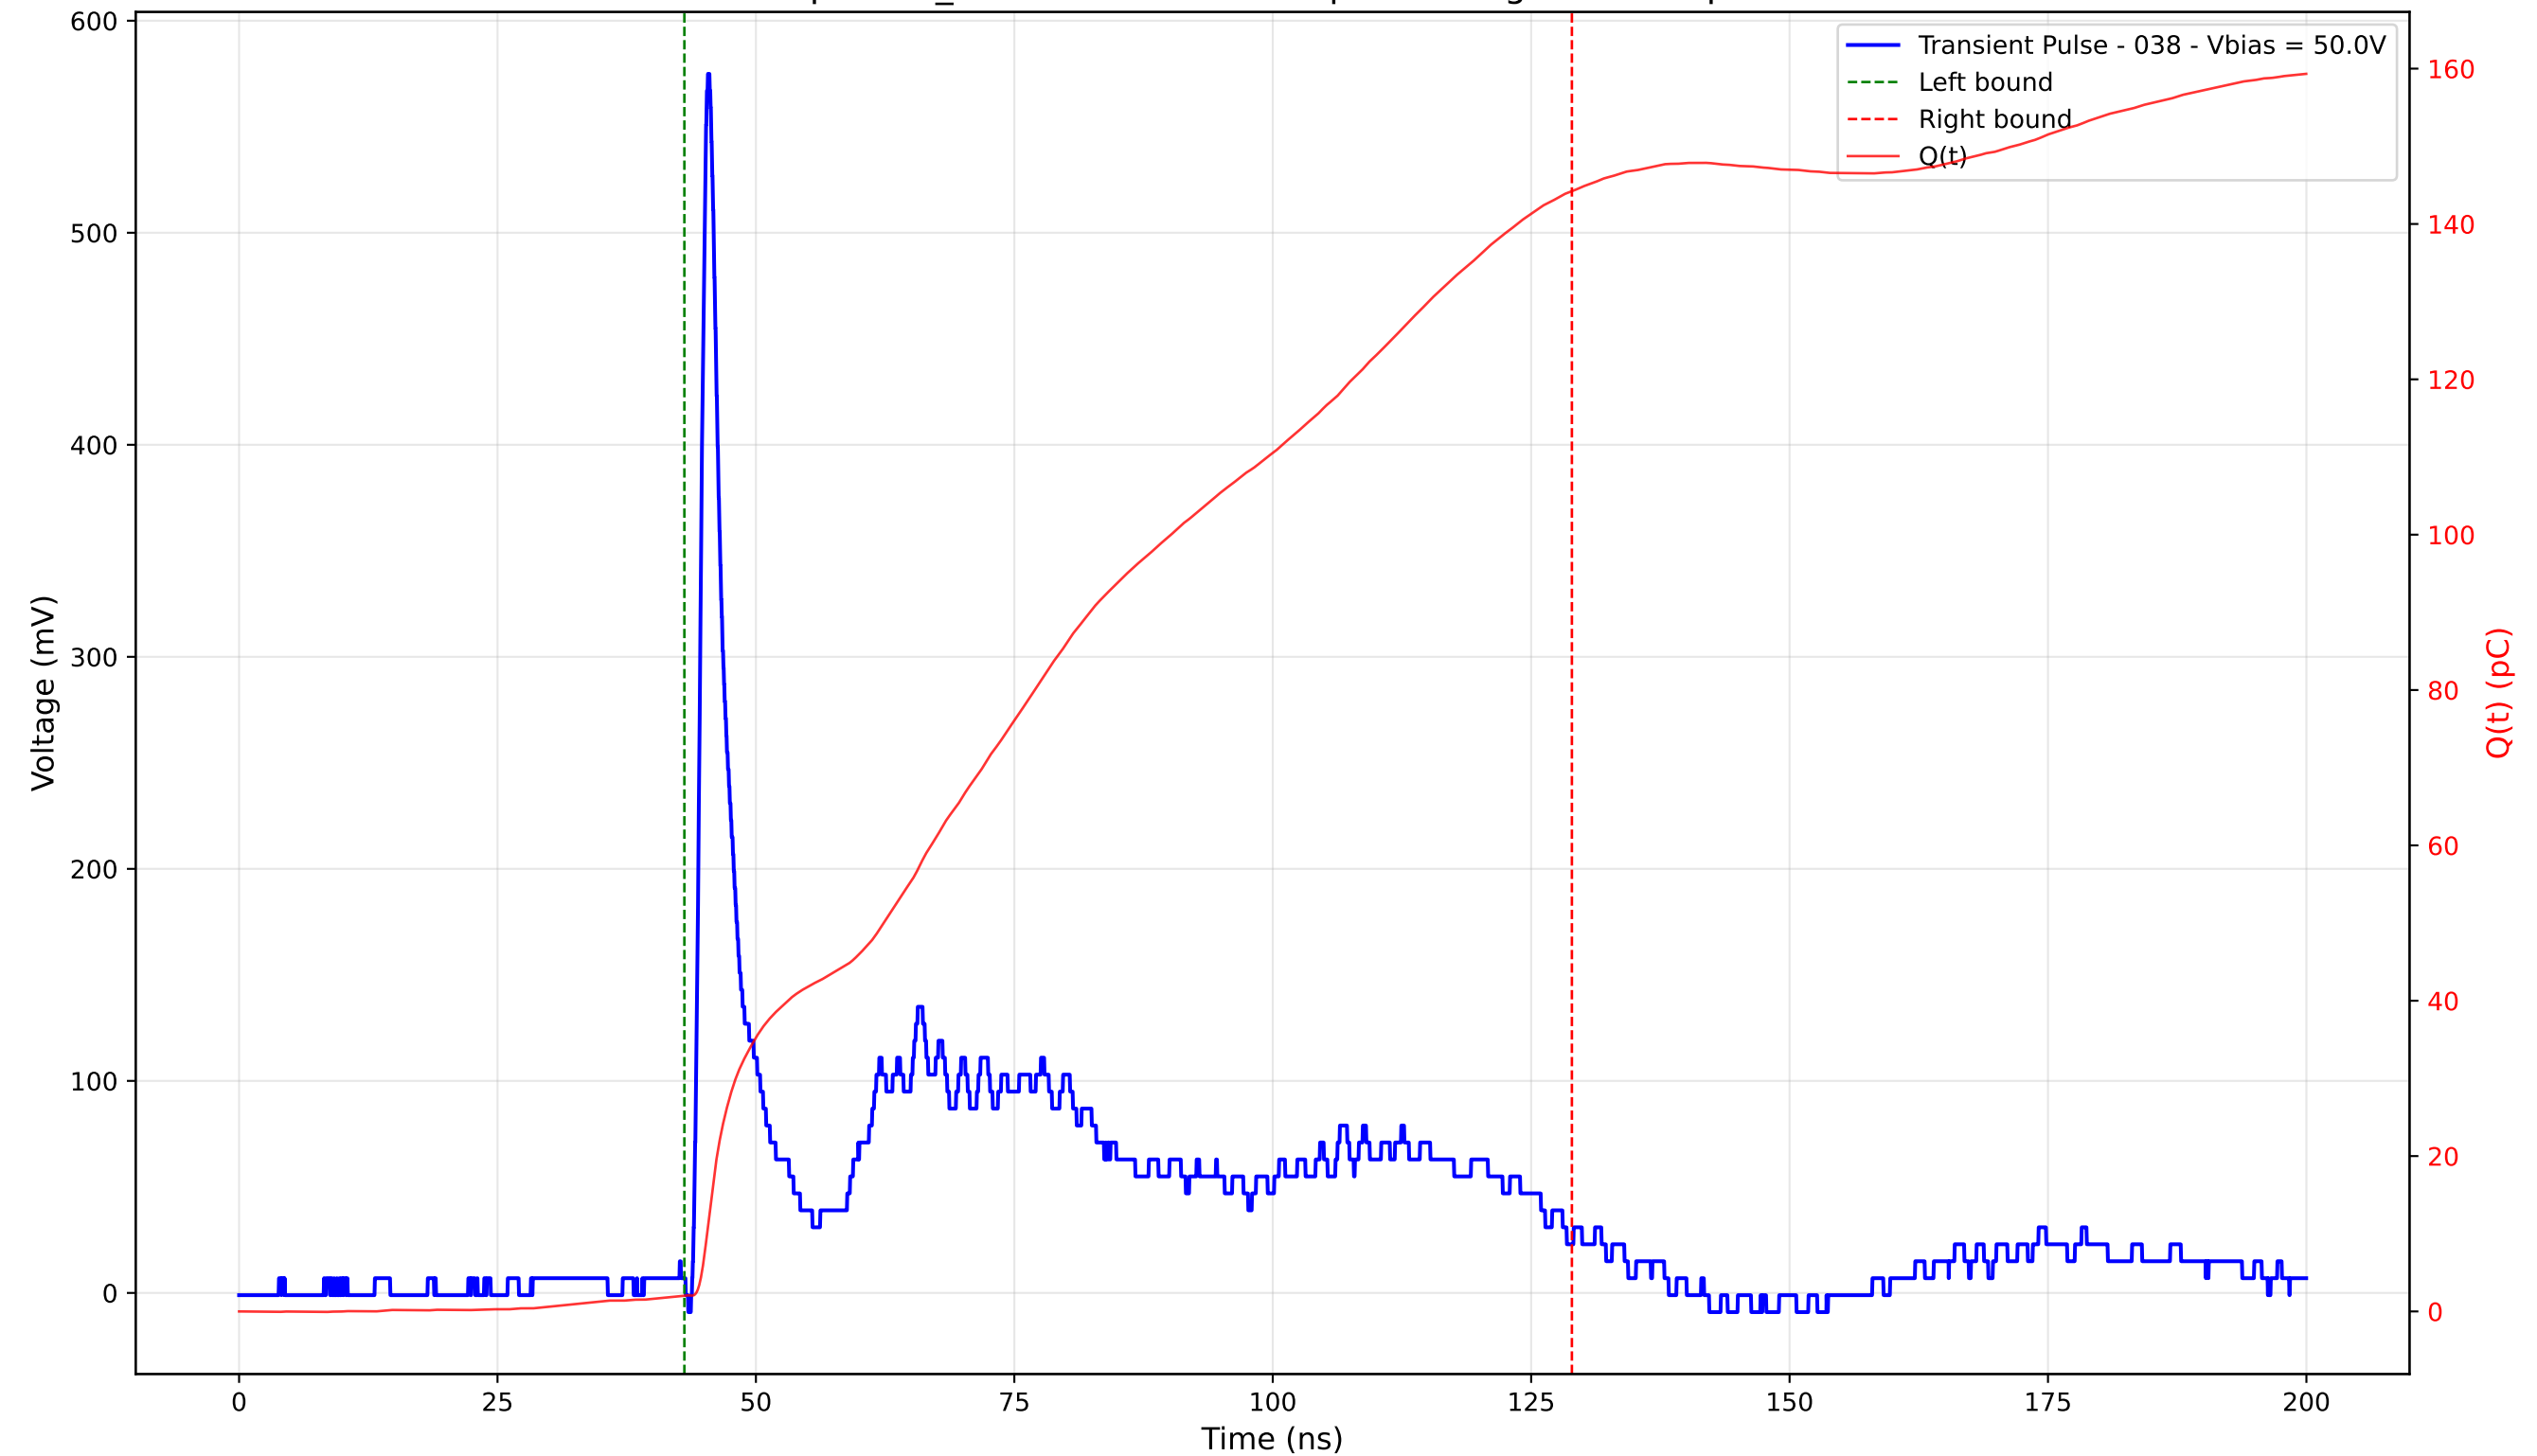


Transient Pulse - Sample: TD_4004 - Position: 100.0 μm - Charge: 150.95 pC - Rise Time: 0.96 ns

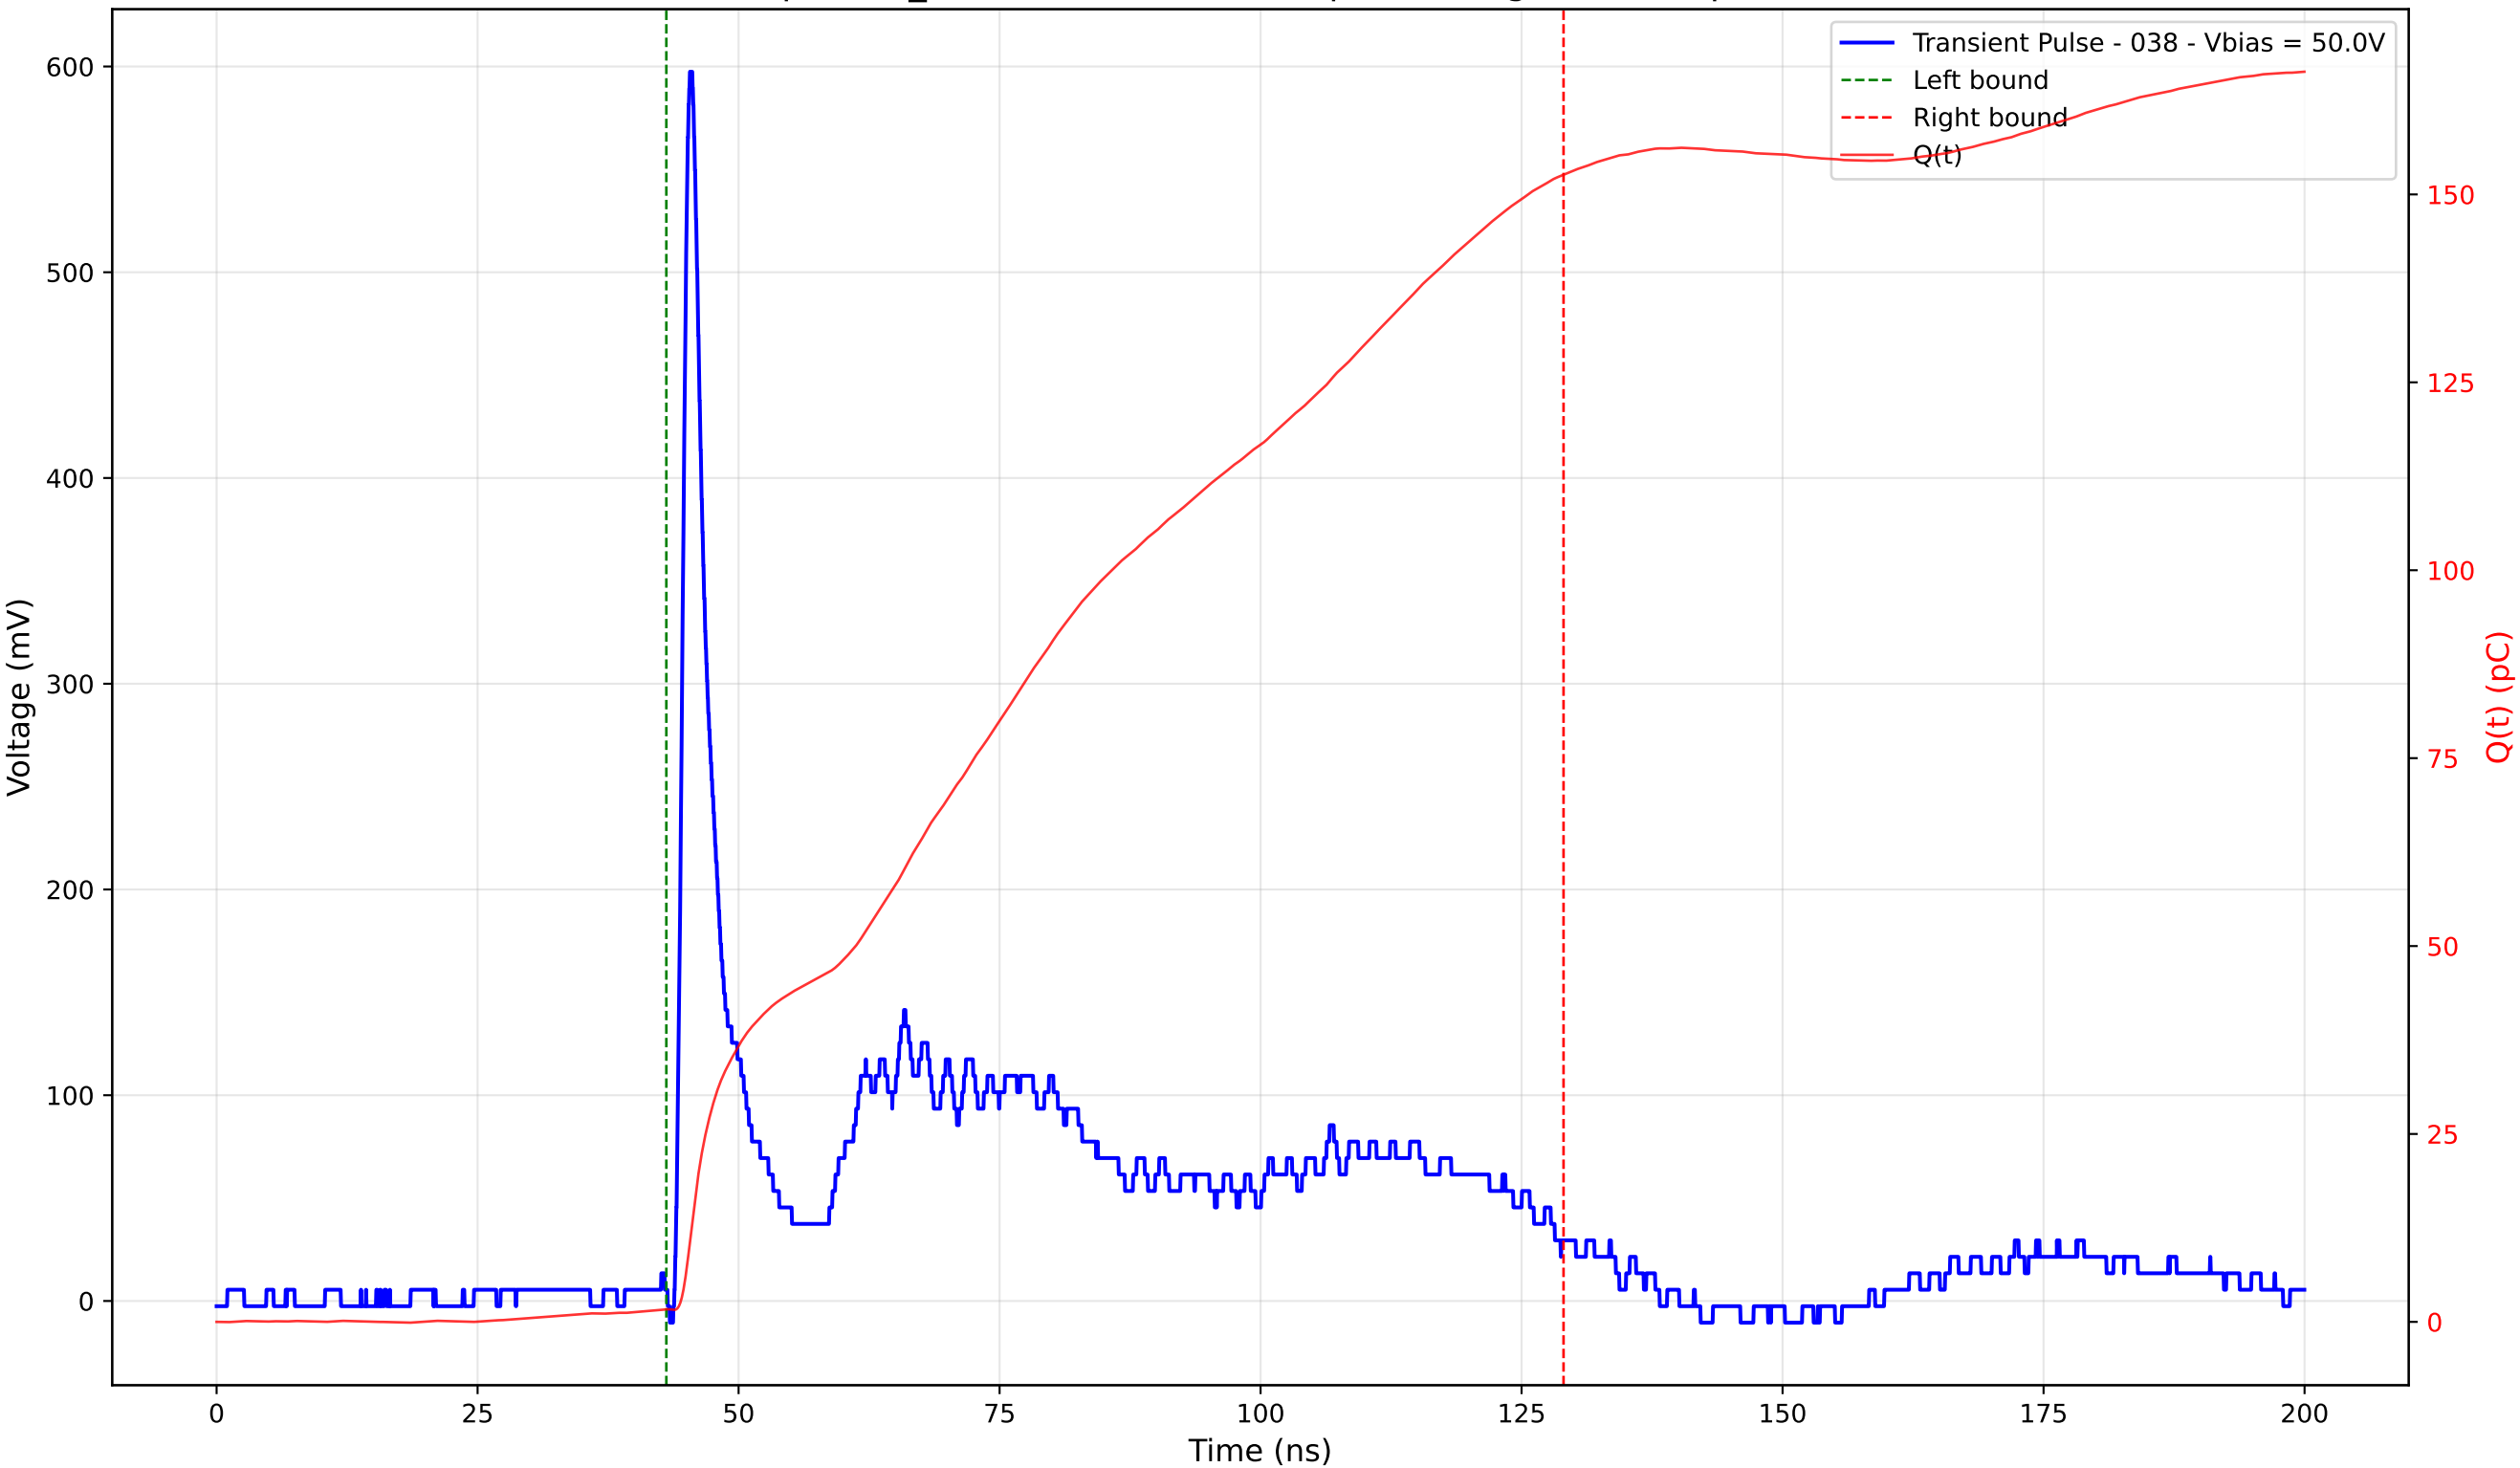


Transient Pulse - Sample: TD_4004 - Position: 105.0 μm - Charge: 151.36 pC - Rise Time: 0.99 ns

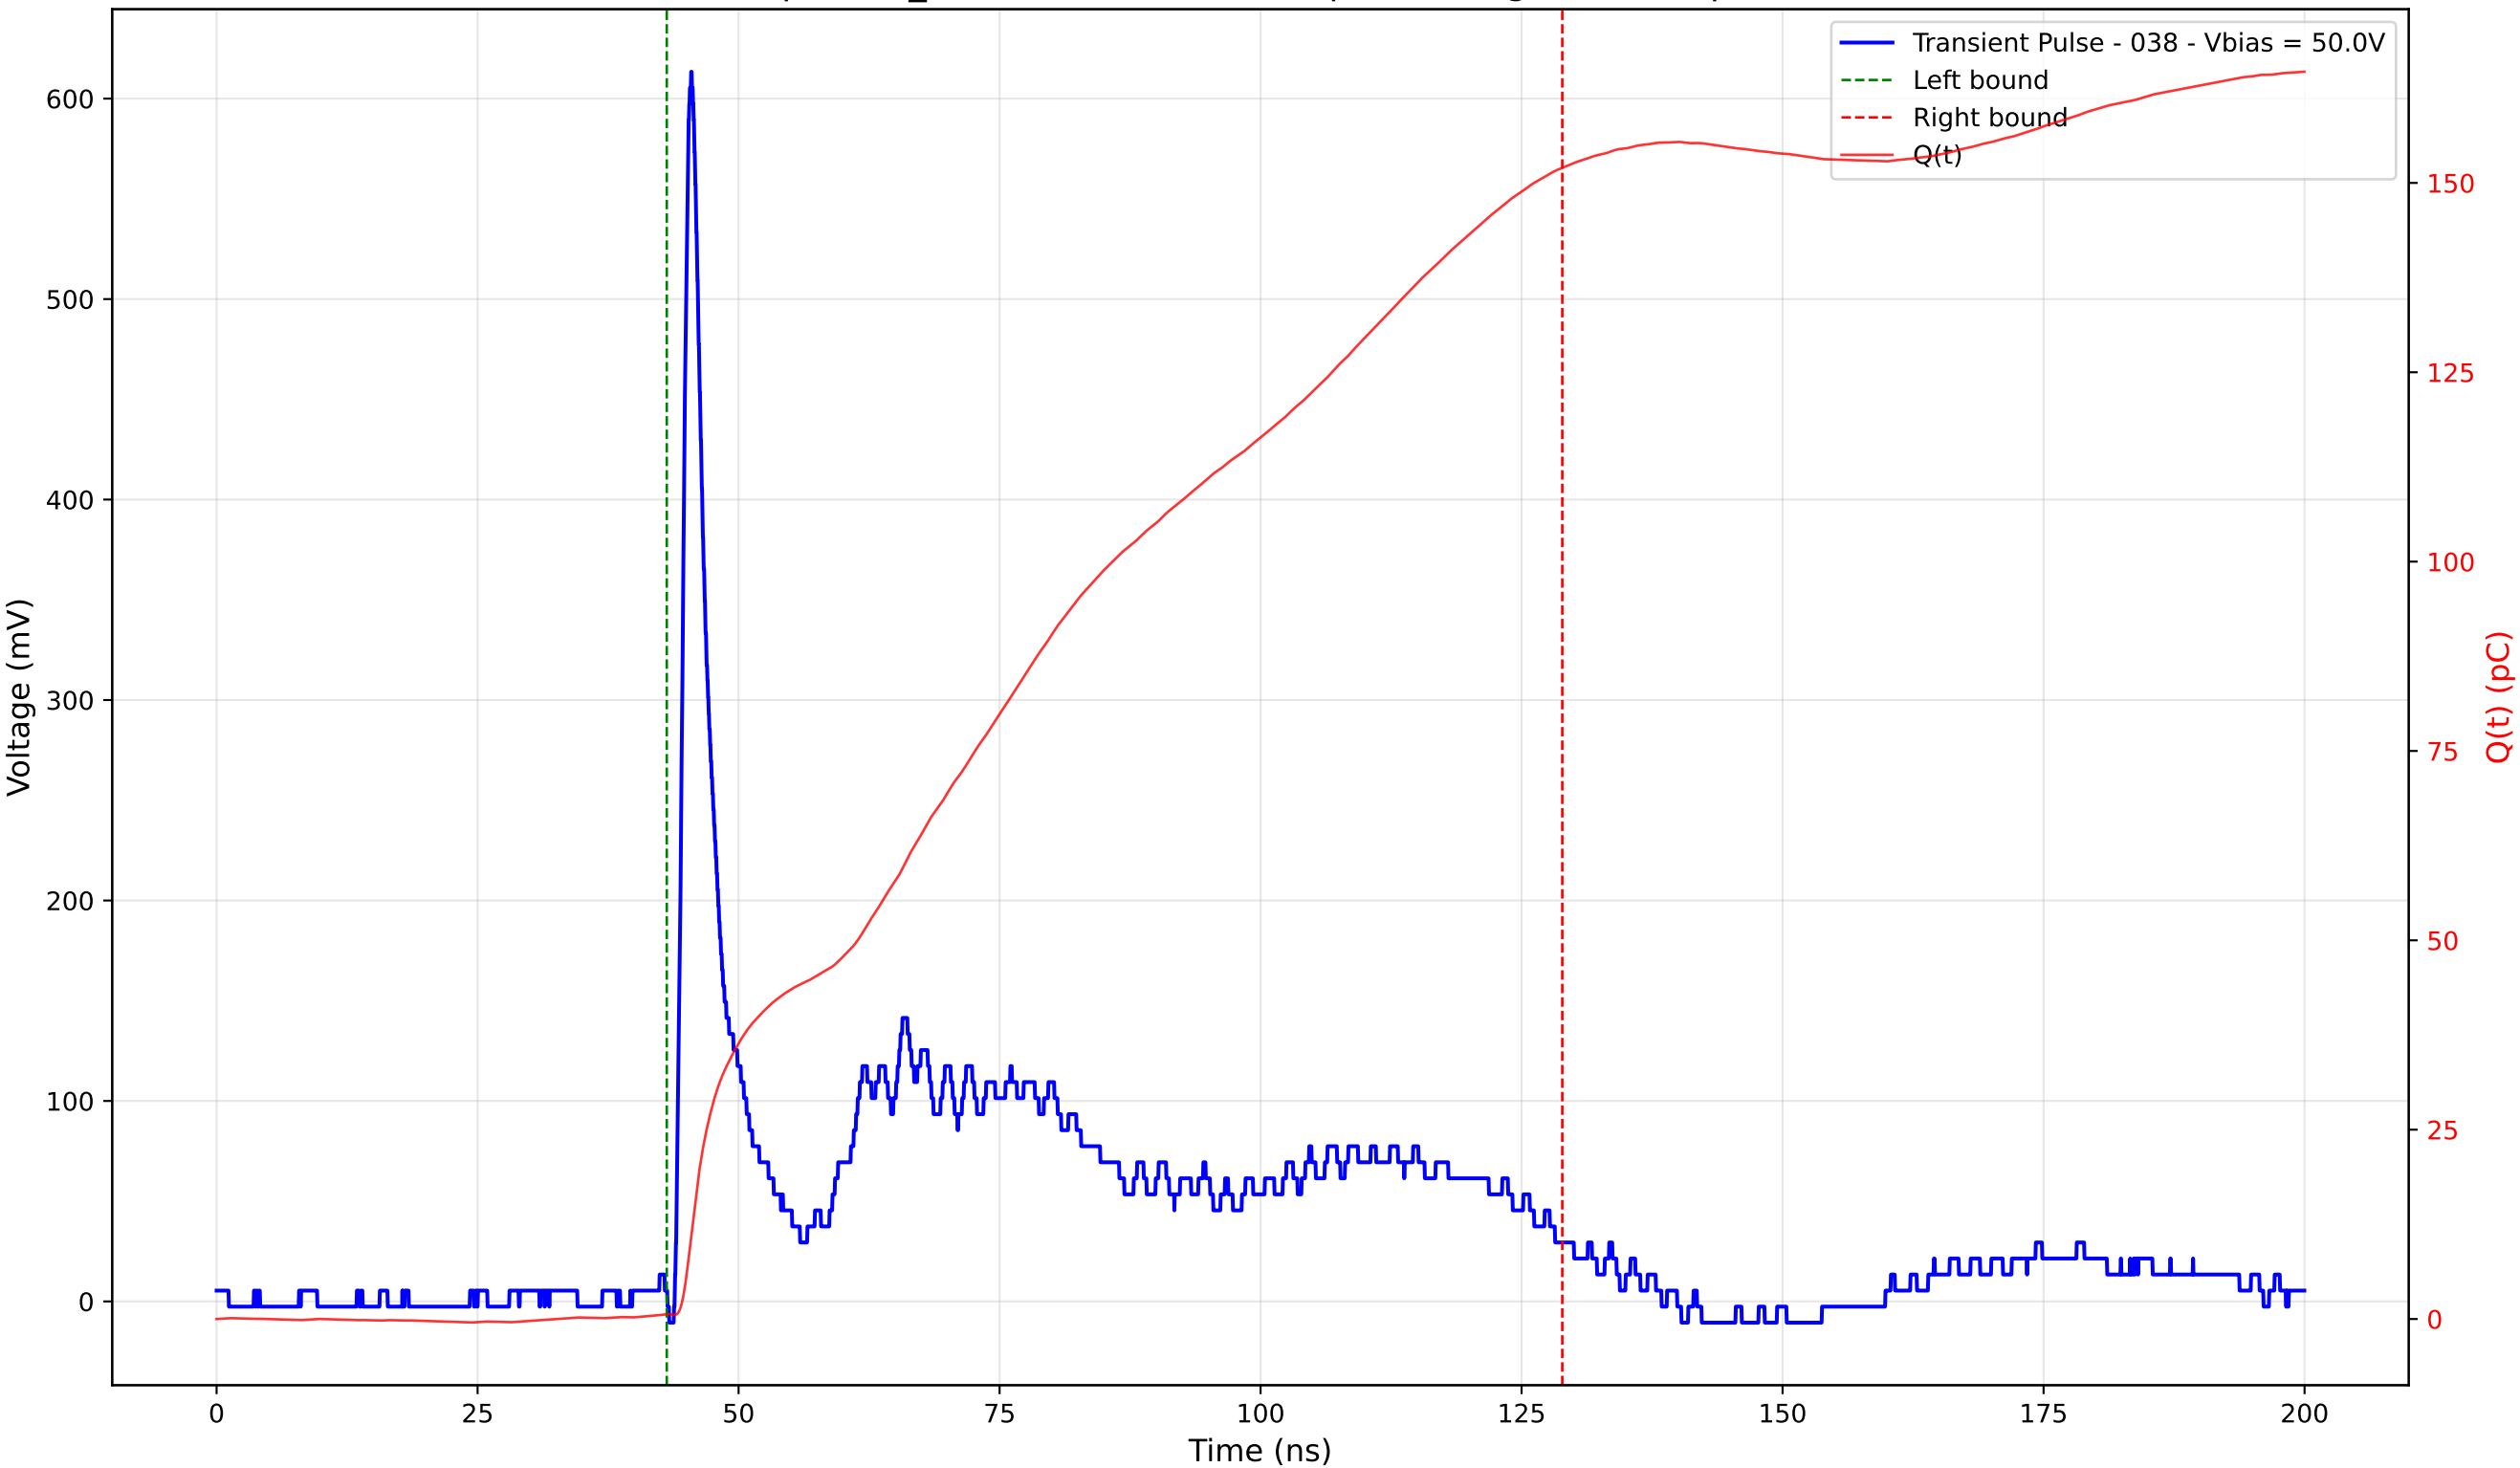


Transient Pulse - Sample: TD_4004 - Position: 110.0 μm - Charge: 150.16 pC - Rise Time: 1.00 ns

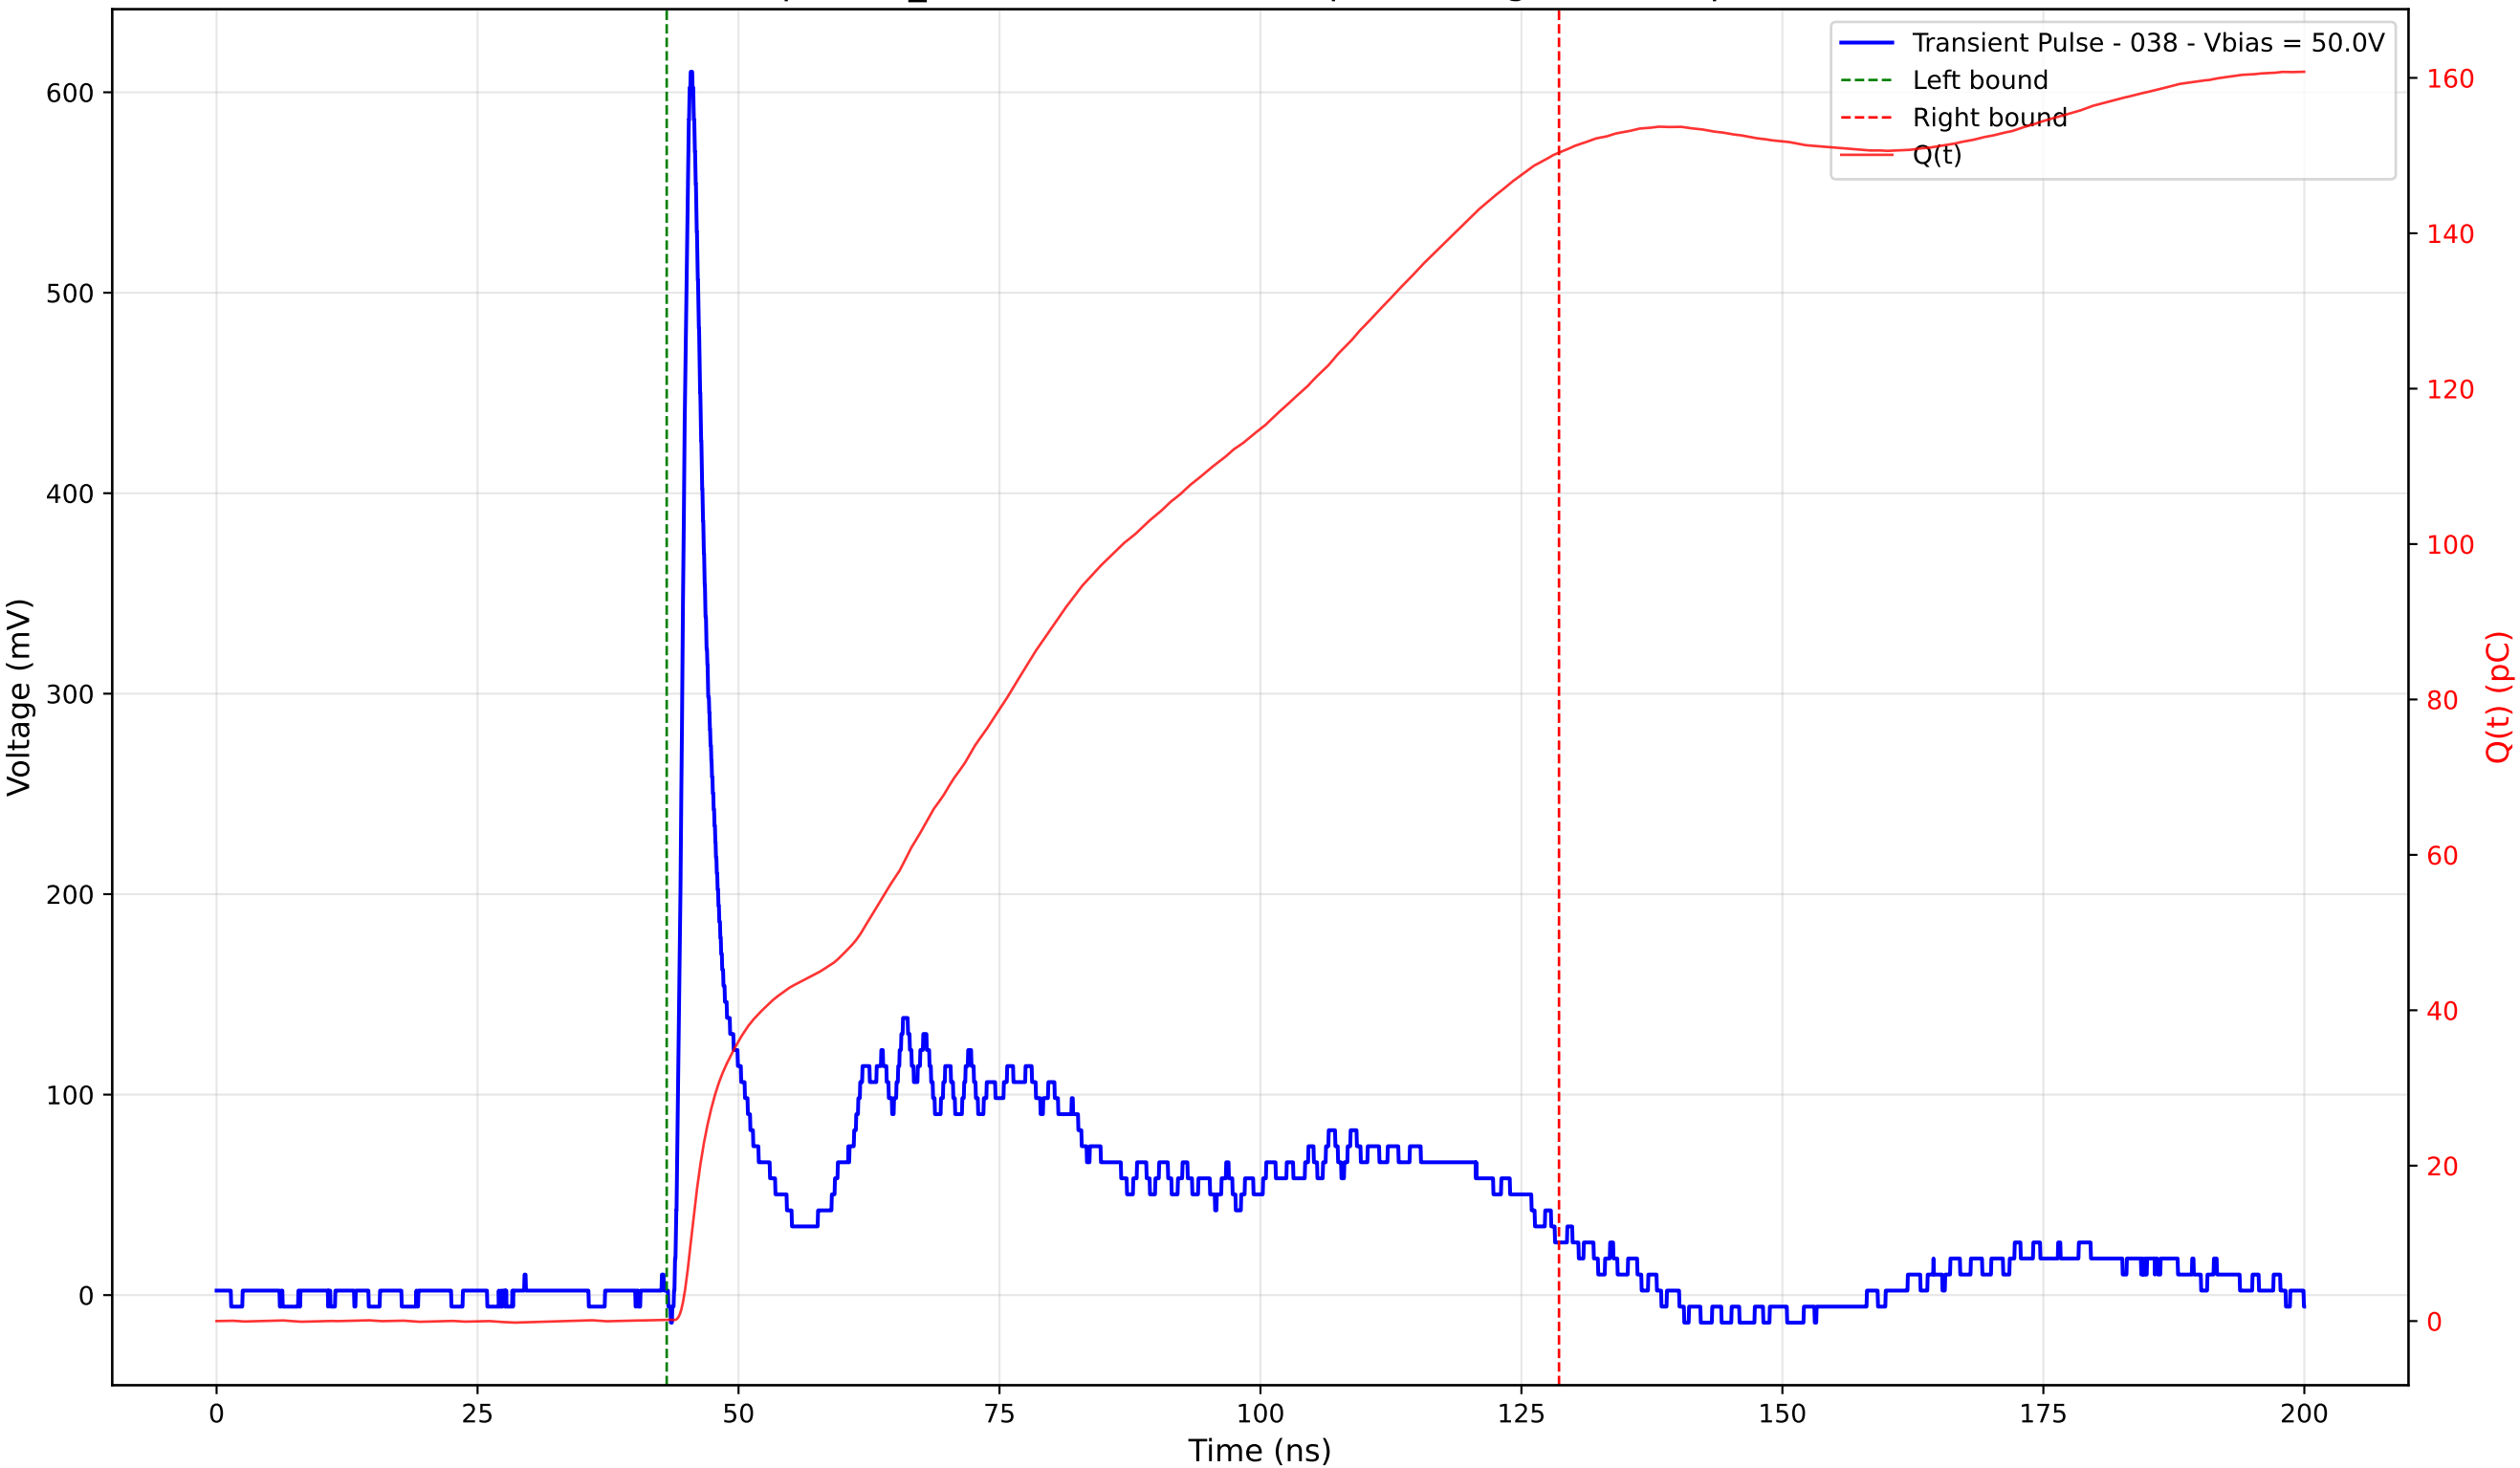


Transient Pulse - Sample: TD_4004 - Position: 115.0 μm - Charge: 144.71 pC - Rise Time: 1.01 ns

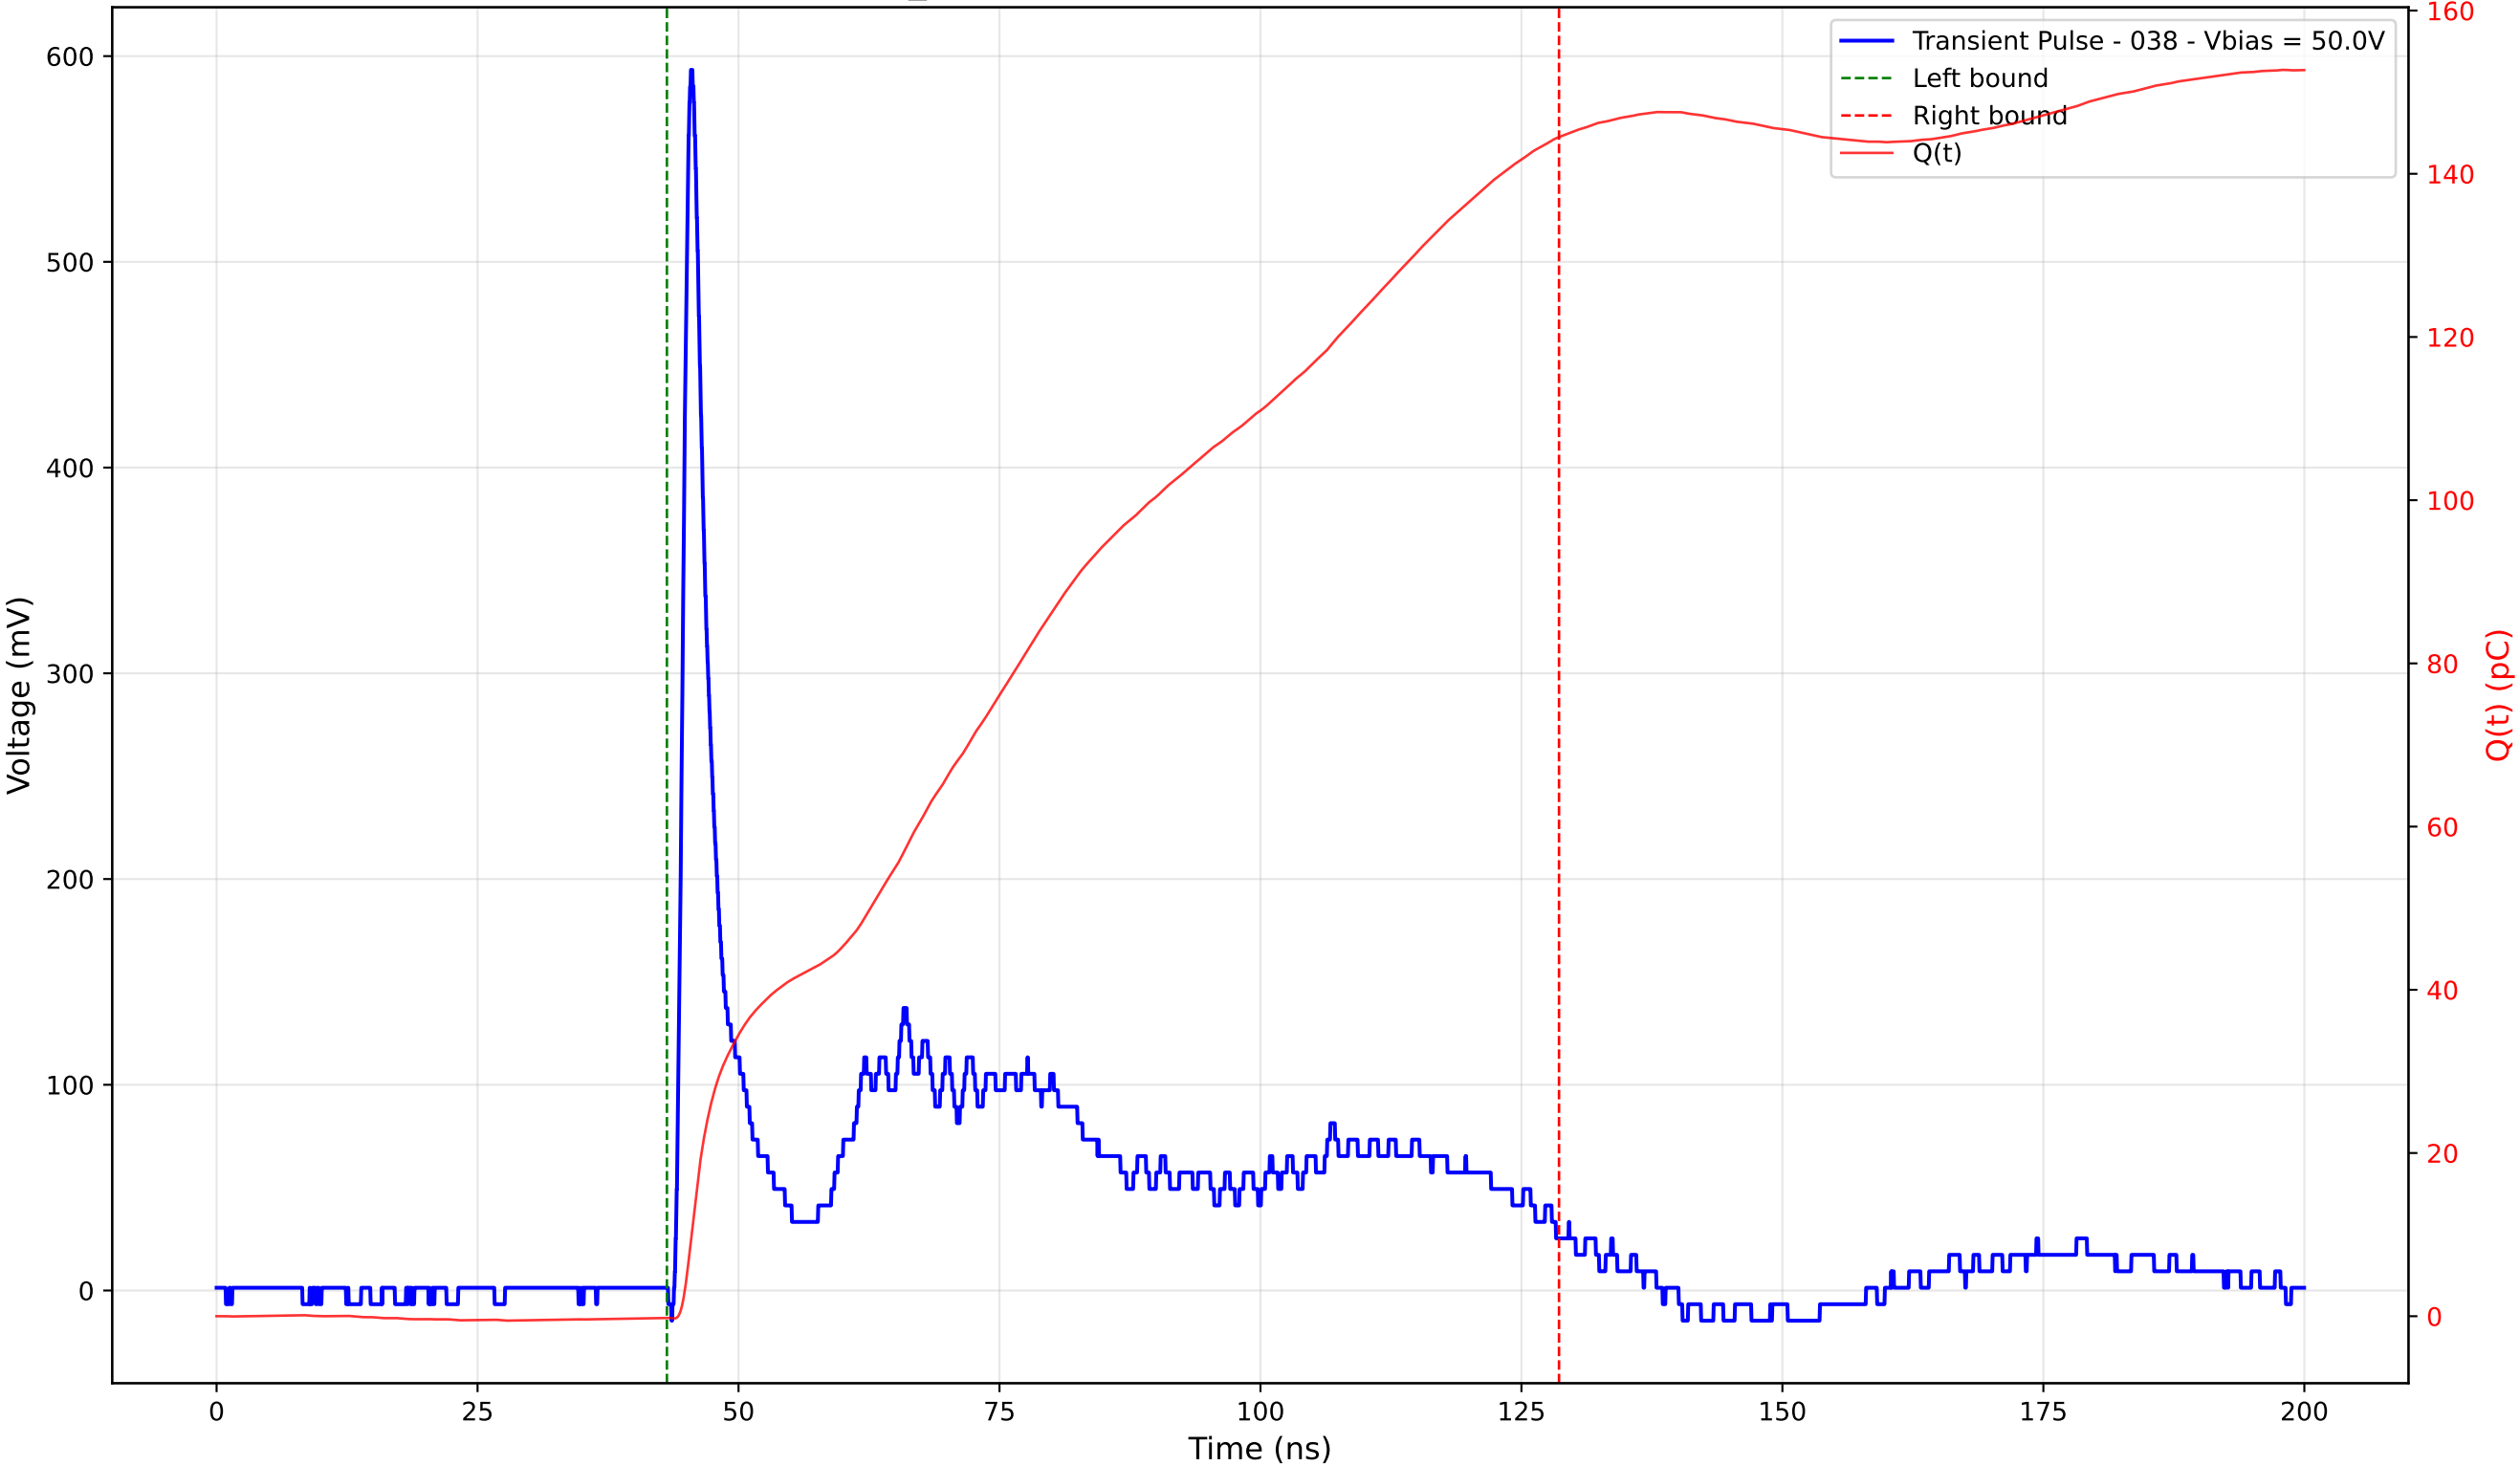


Transient Pulse - Sample: TD_4004 - Position: 120.0 μm - Charge: 138.44 pC - Rise Time: 1.03 ns

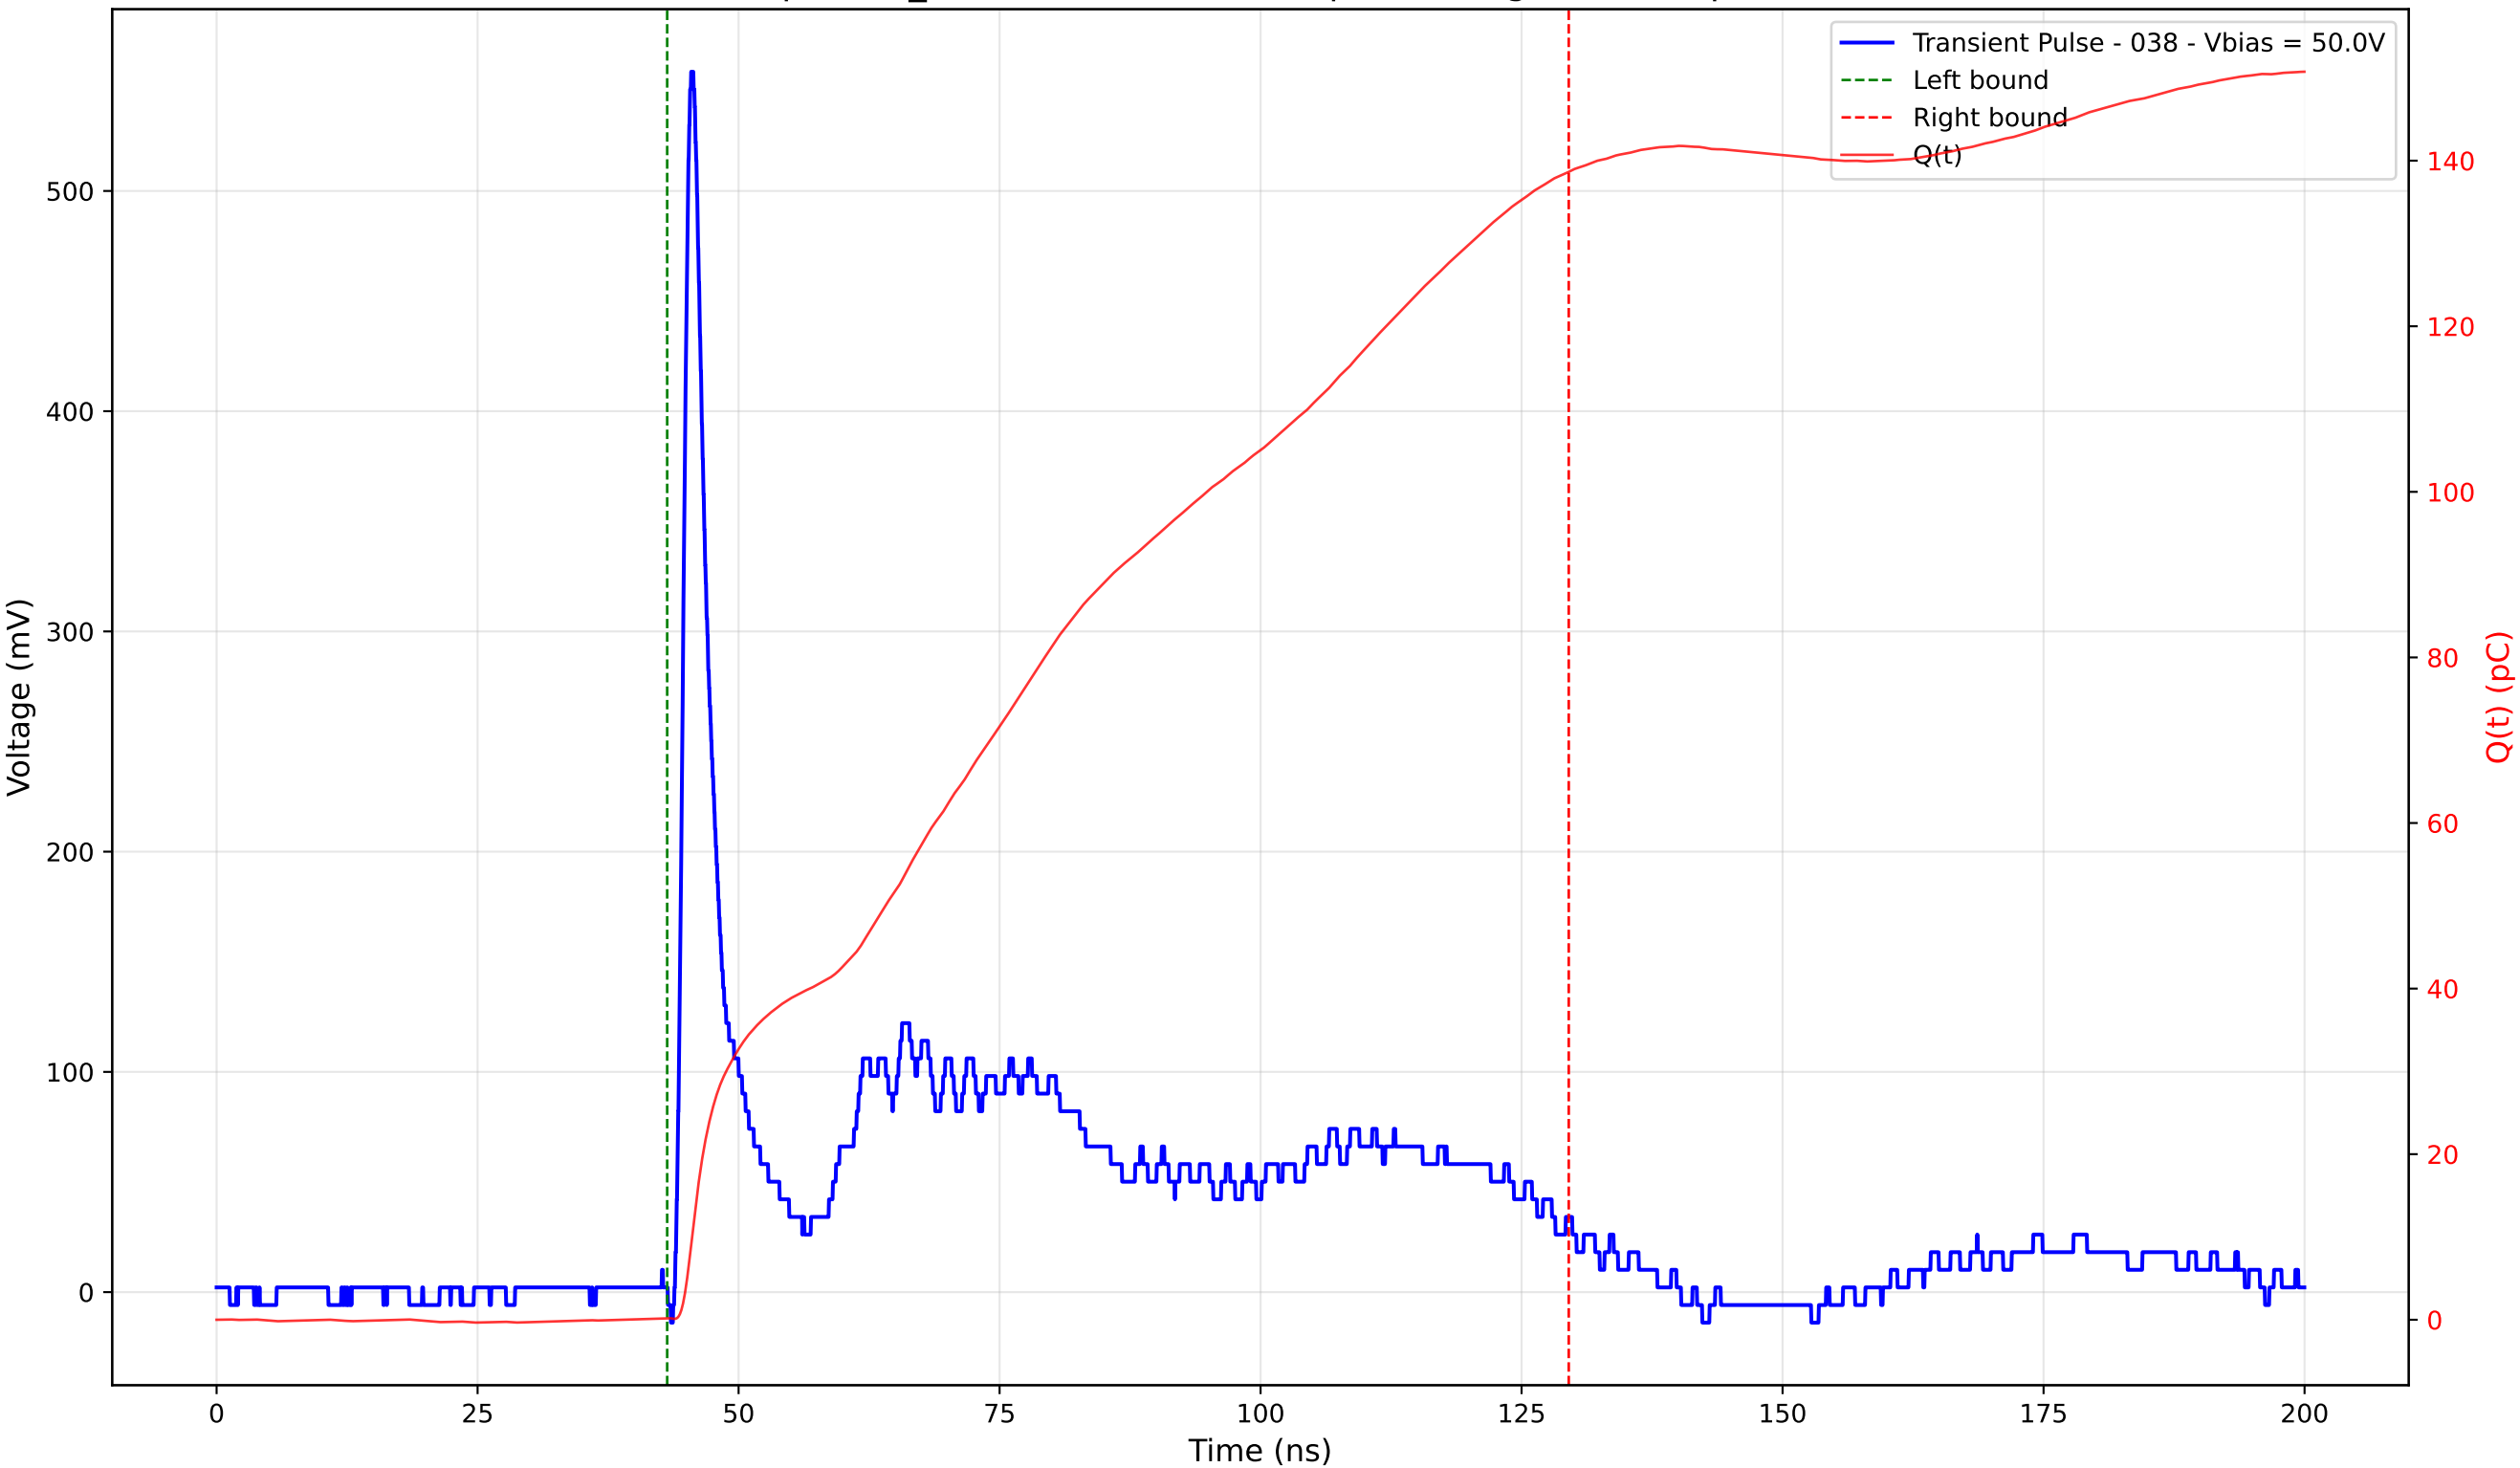


Transient Pulse - Sample: TD_4004 - Position: 125.0 μm - Charge: 130.59 pC - Rise Time: 1.05 ns

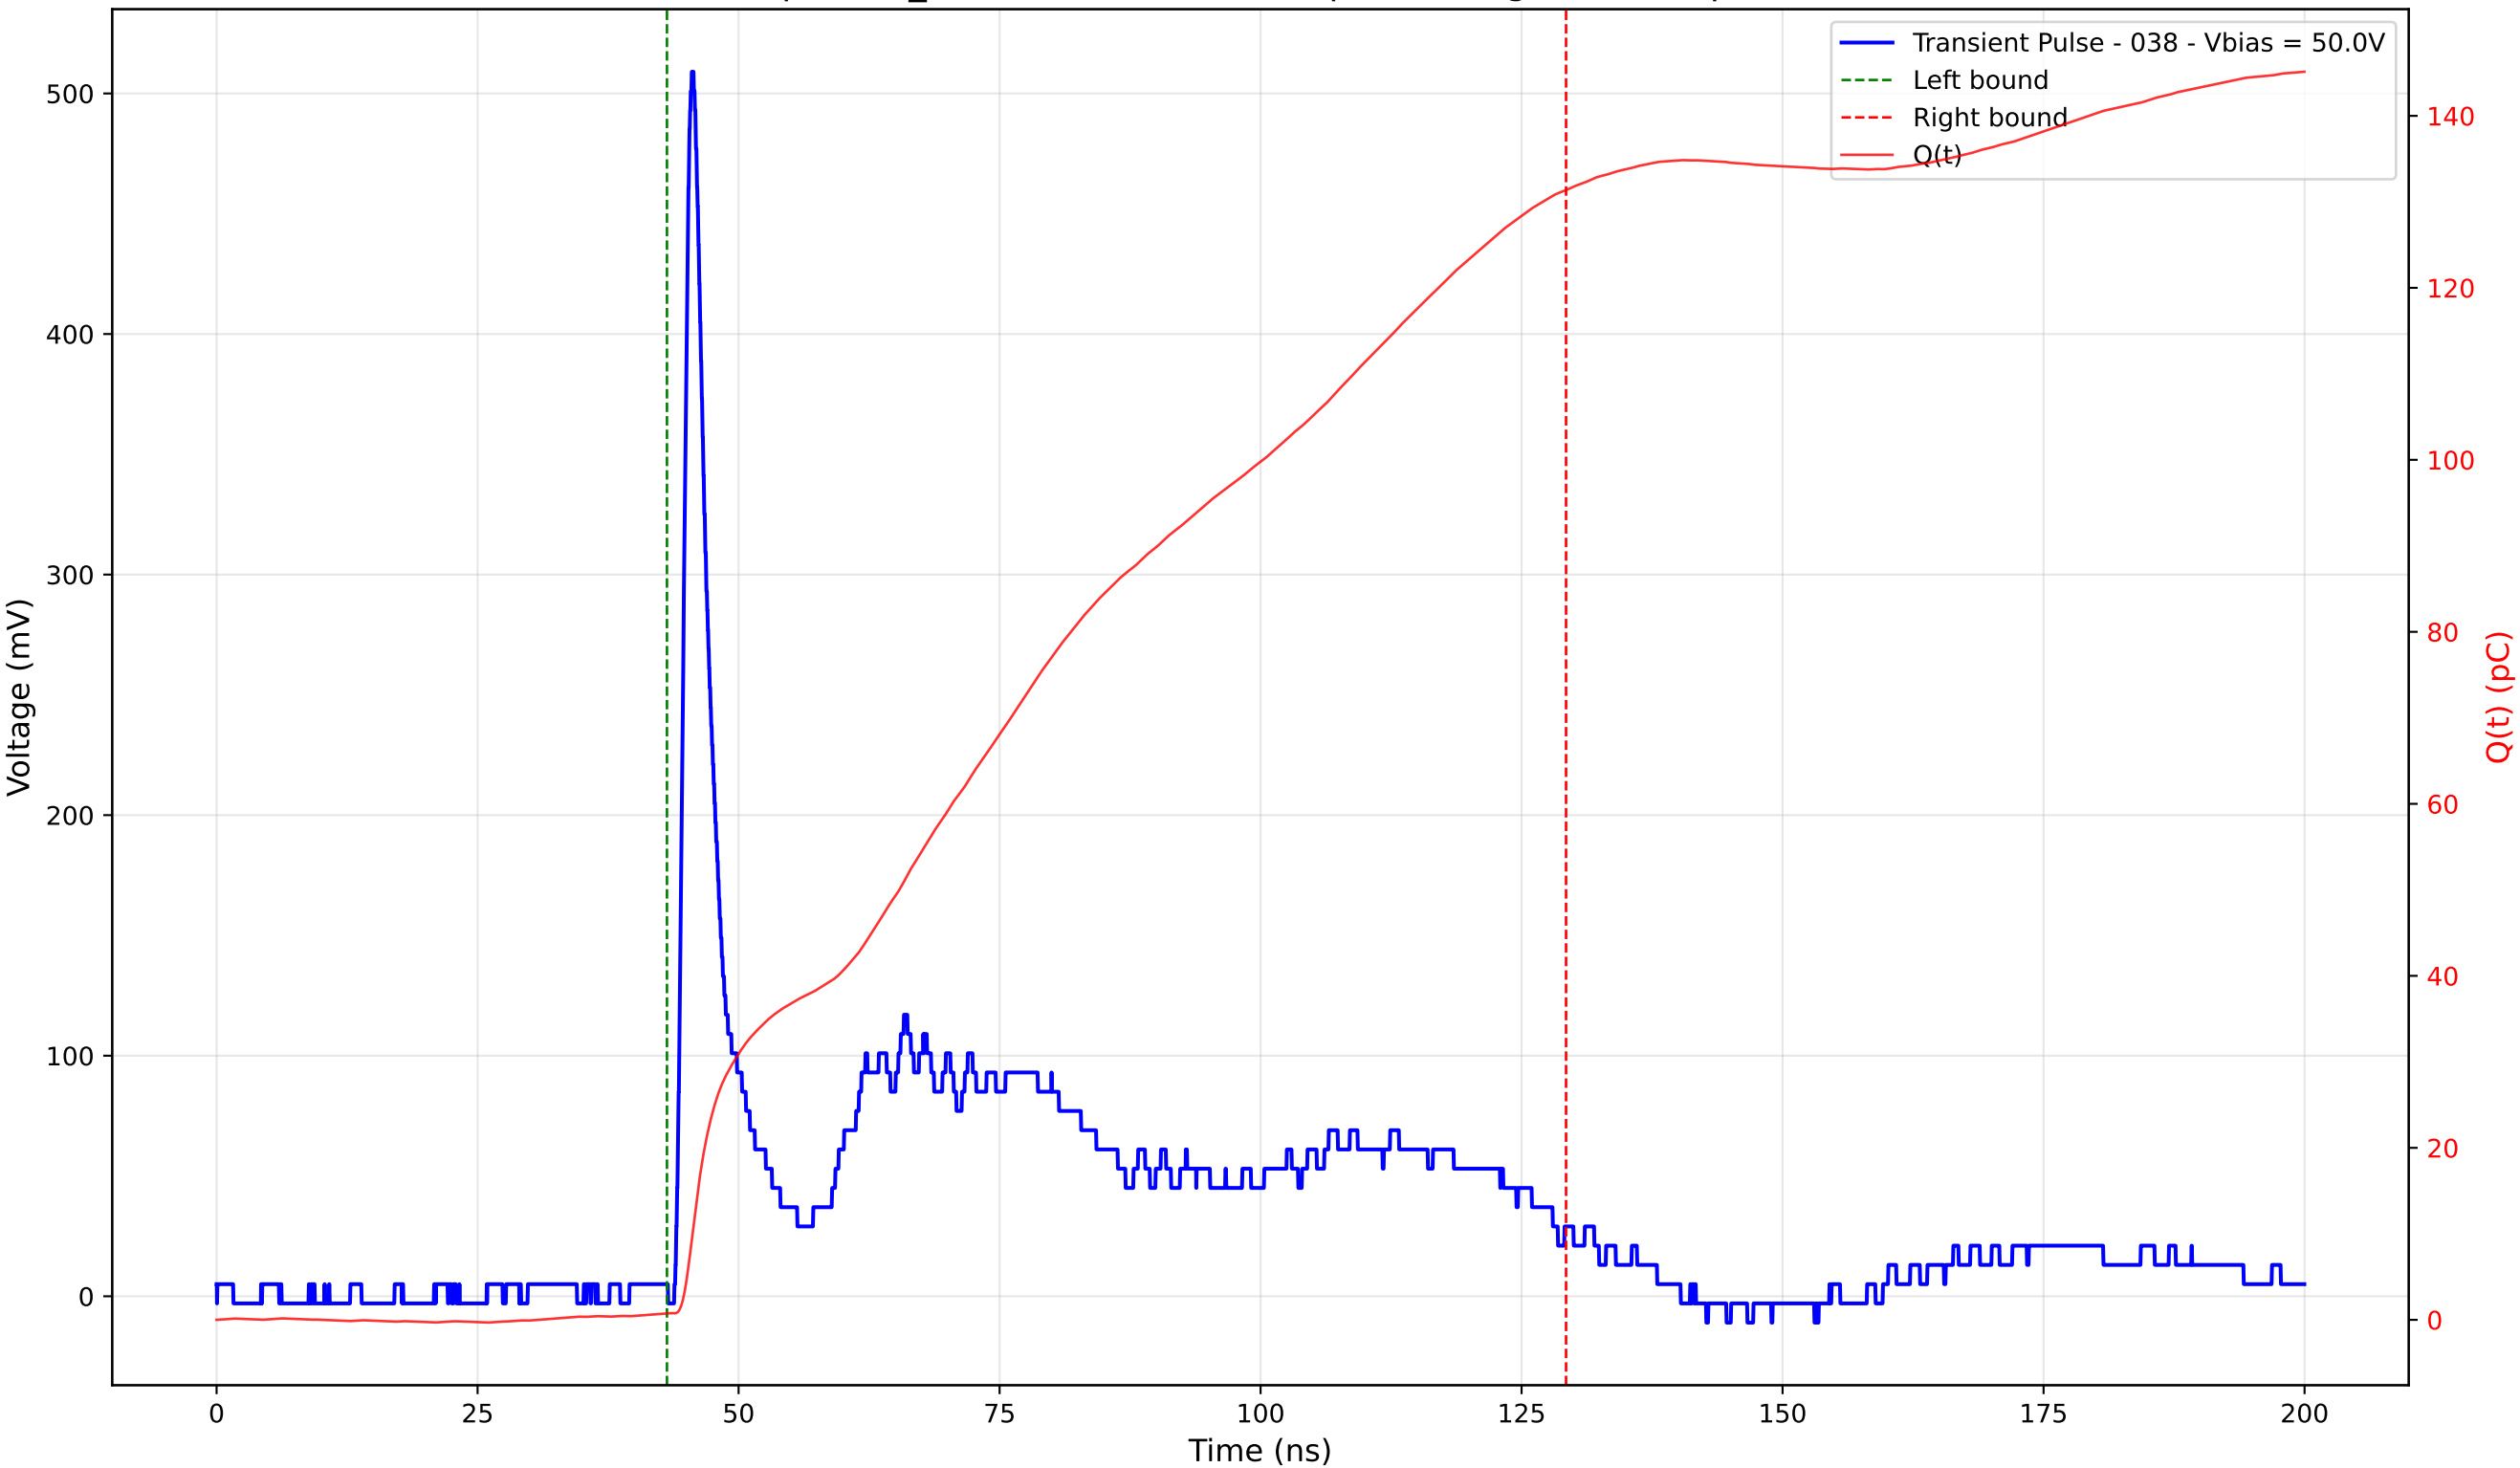


Transient Pulse - Sample: TD_4004 - Position: 130.0 μm - Charge: 111.57 pC - Rise Time: 1.04 ns

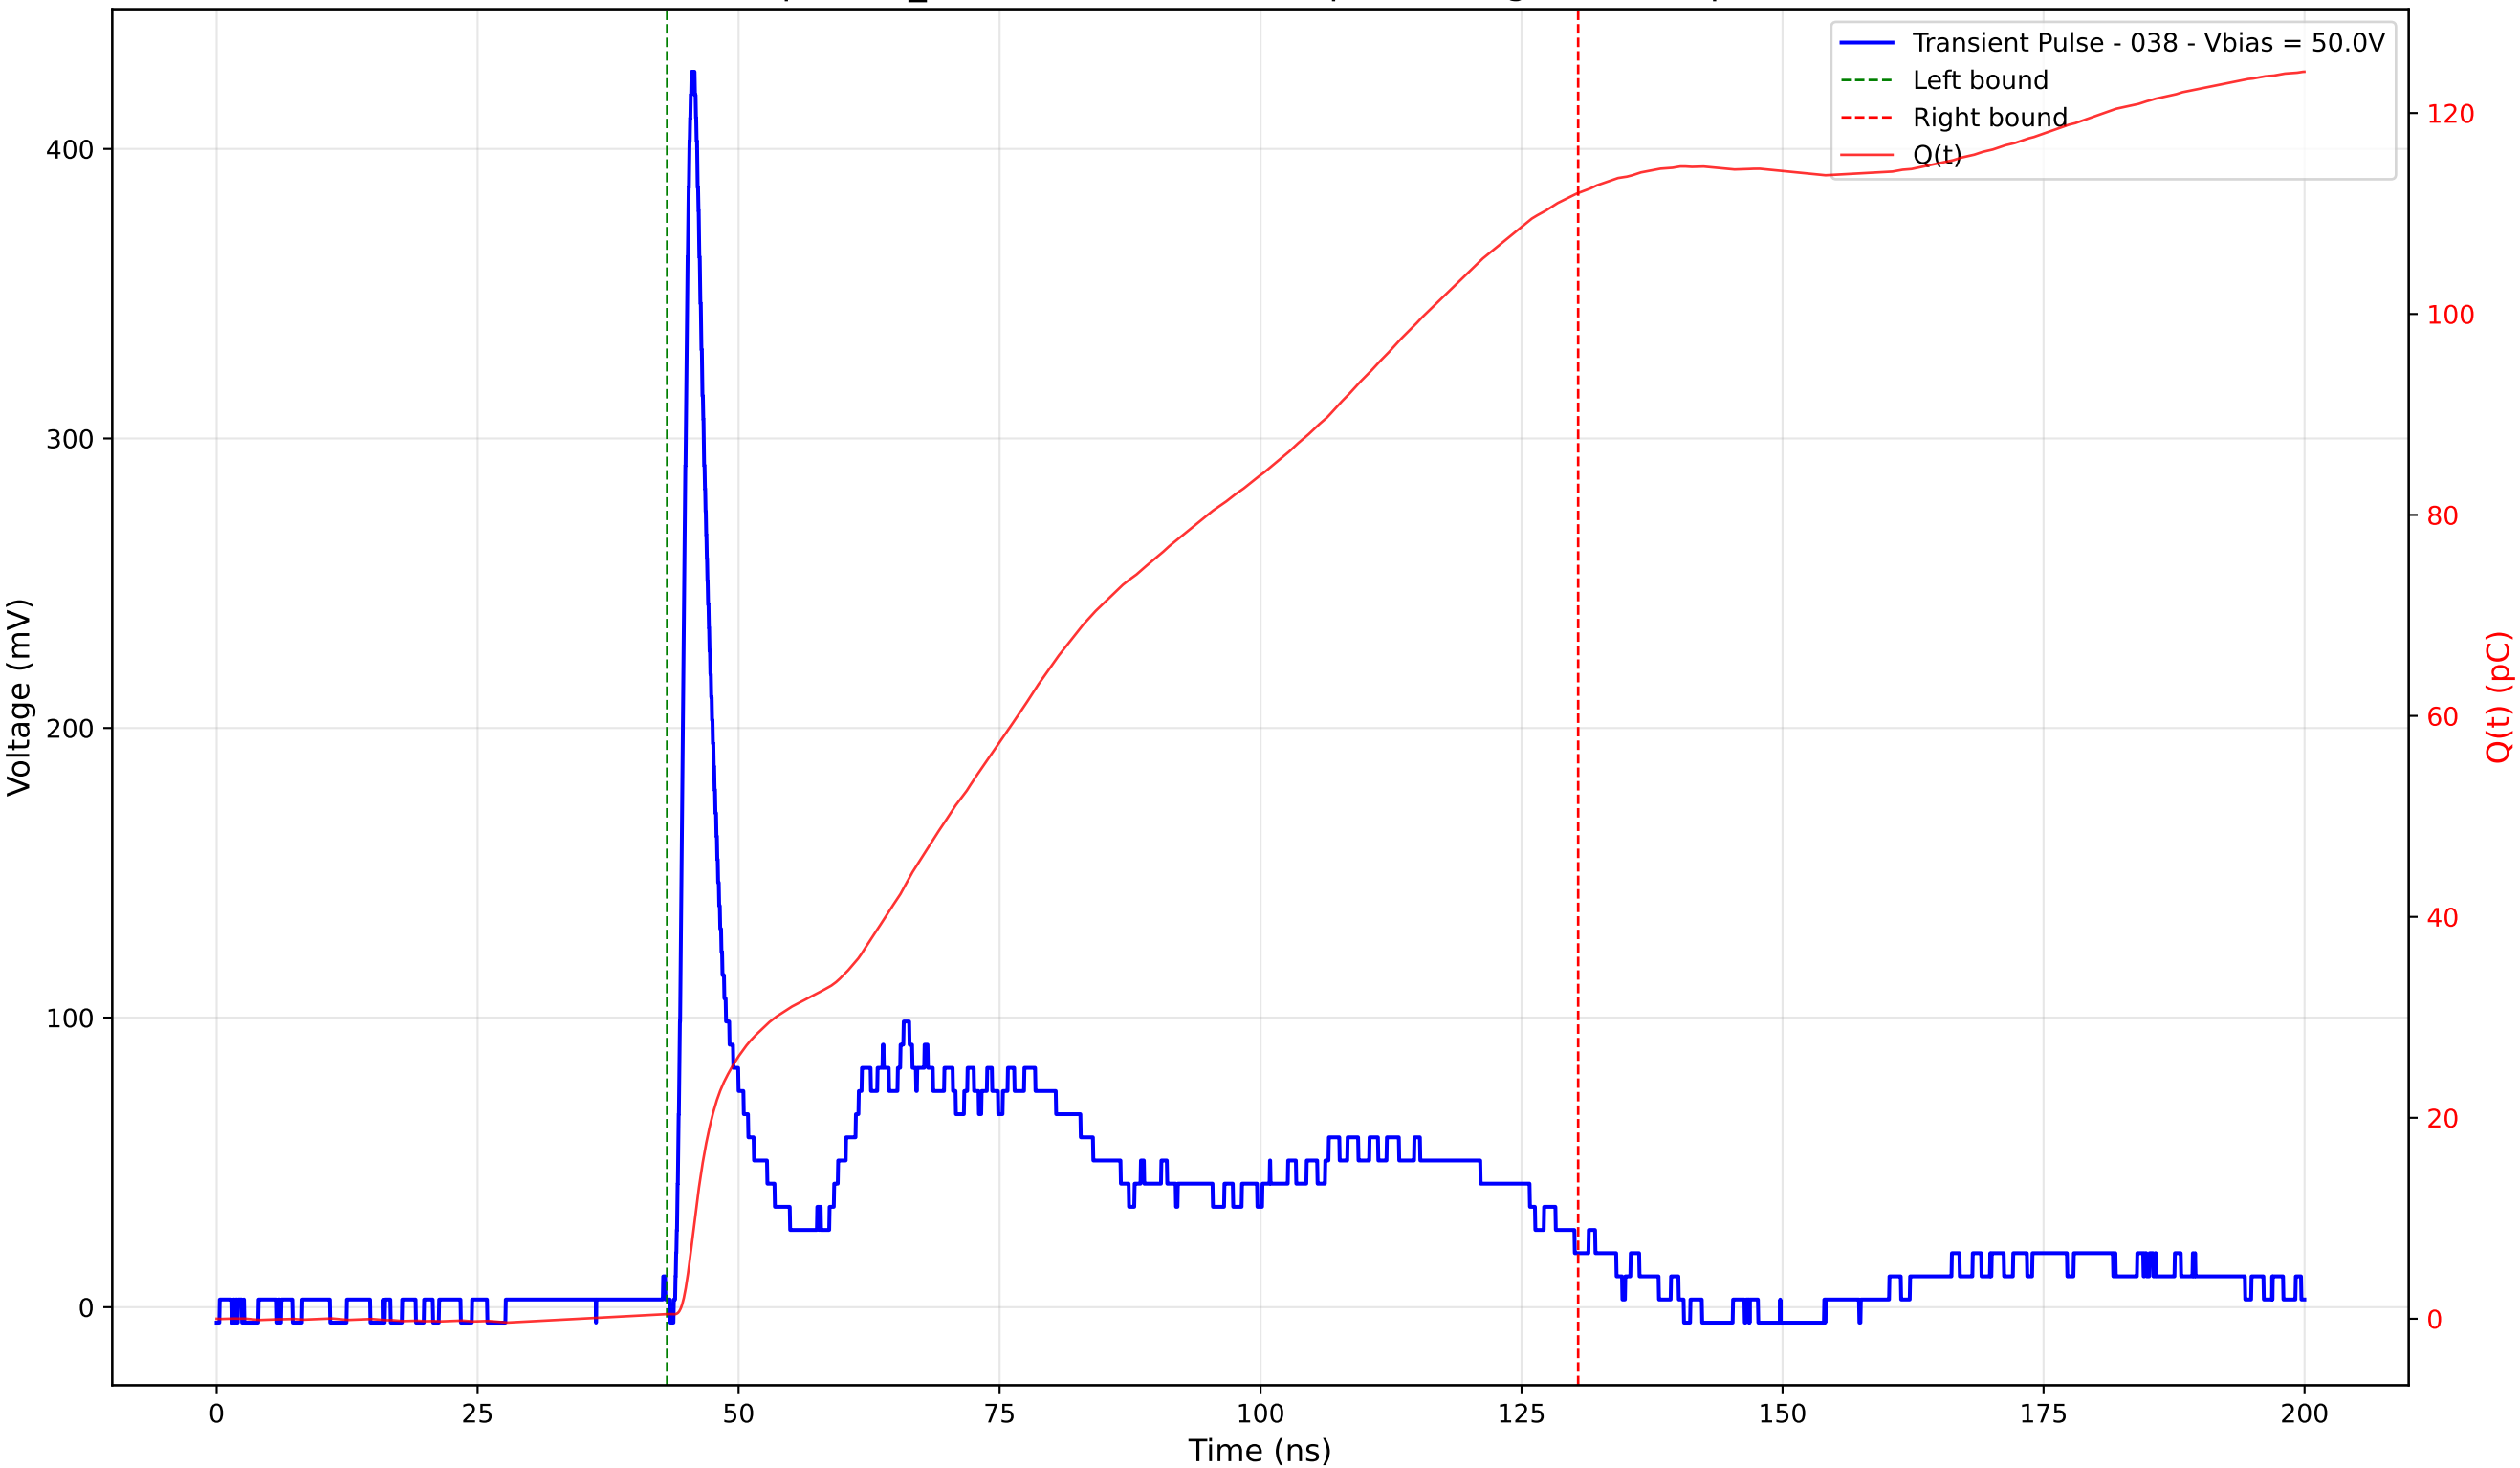


Transient Pulse - Sample: TD_4004 - Position: 135.0 μm - Charge: 98.15 pC - Rise Time: 1.09 ns

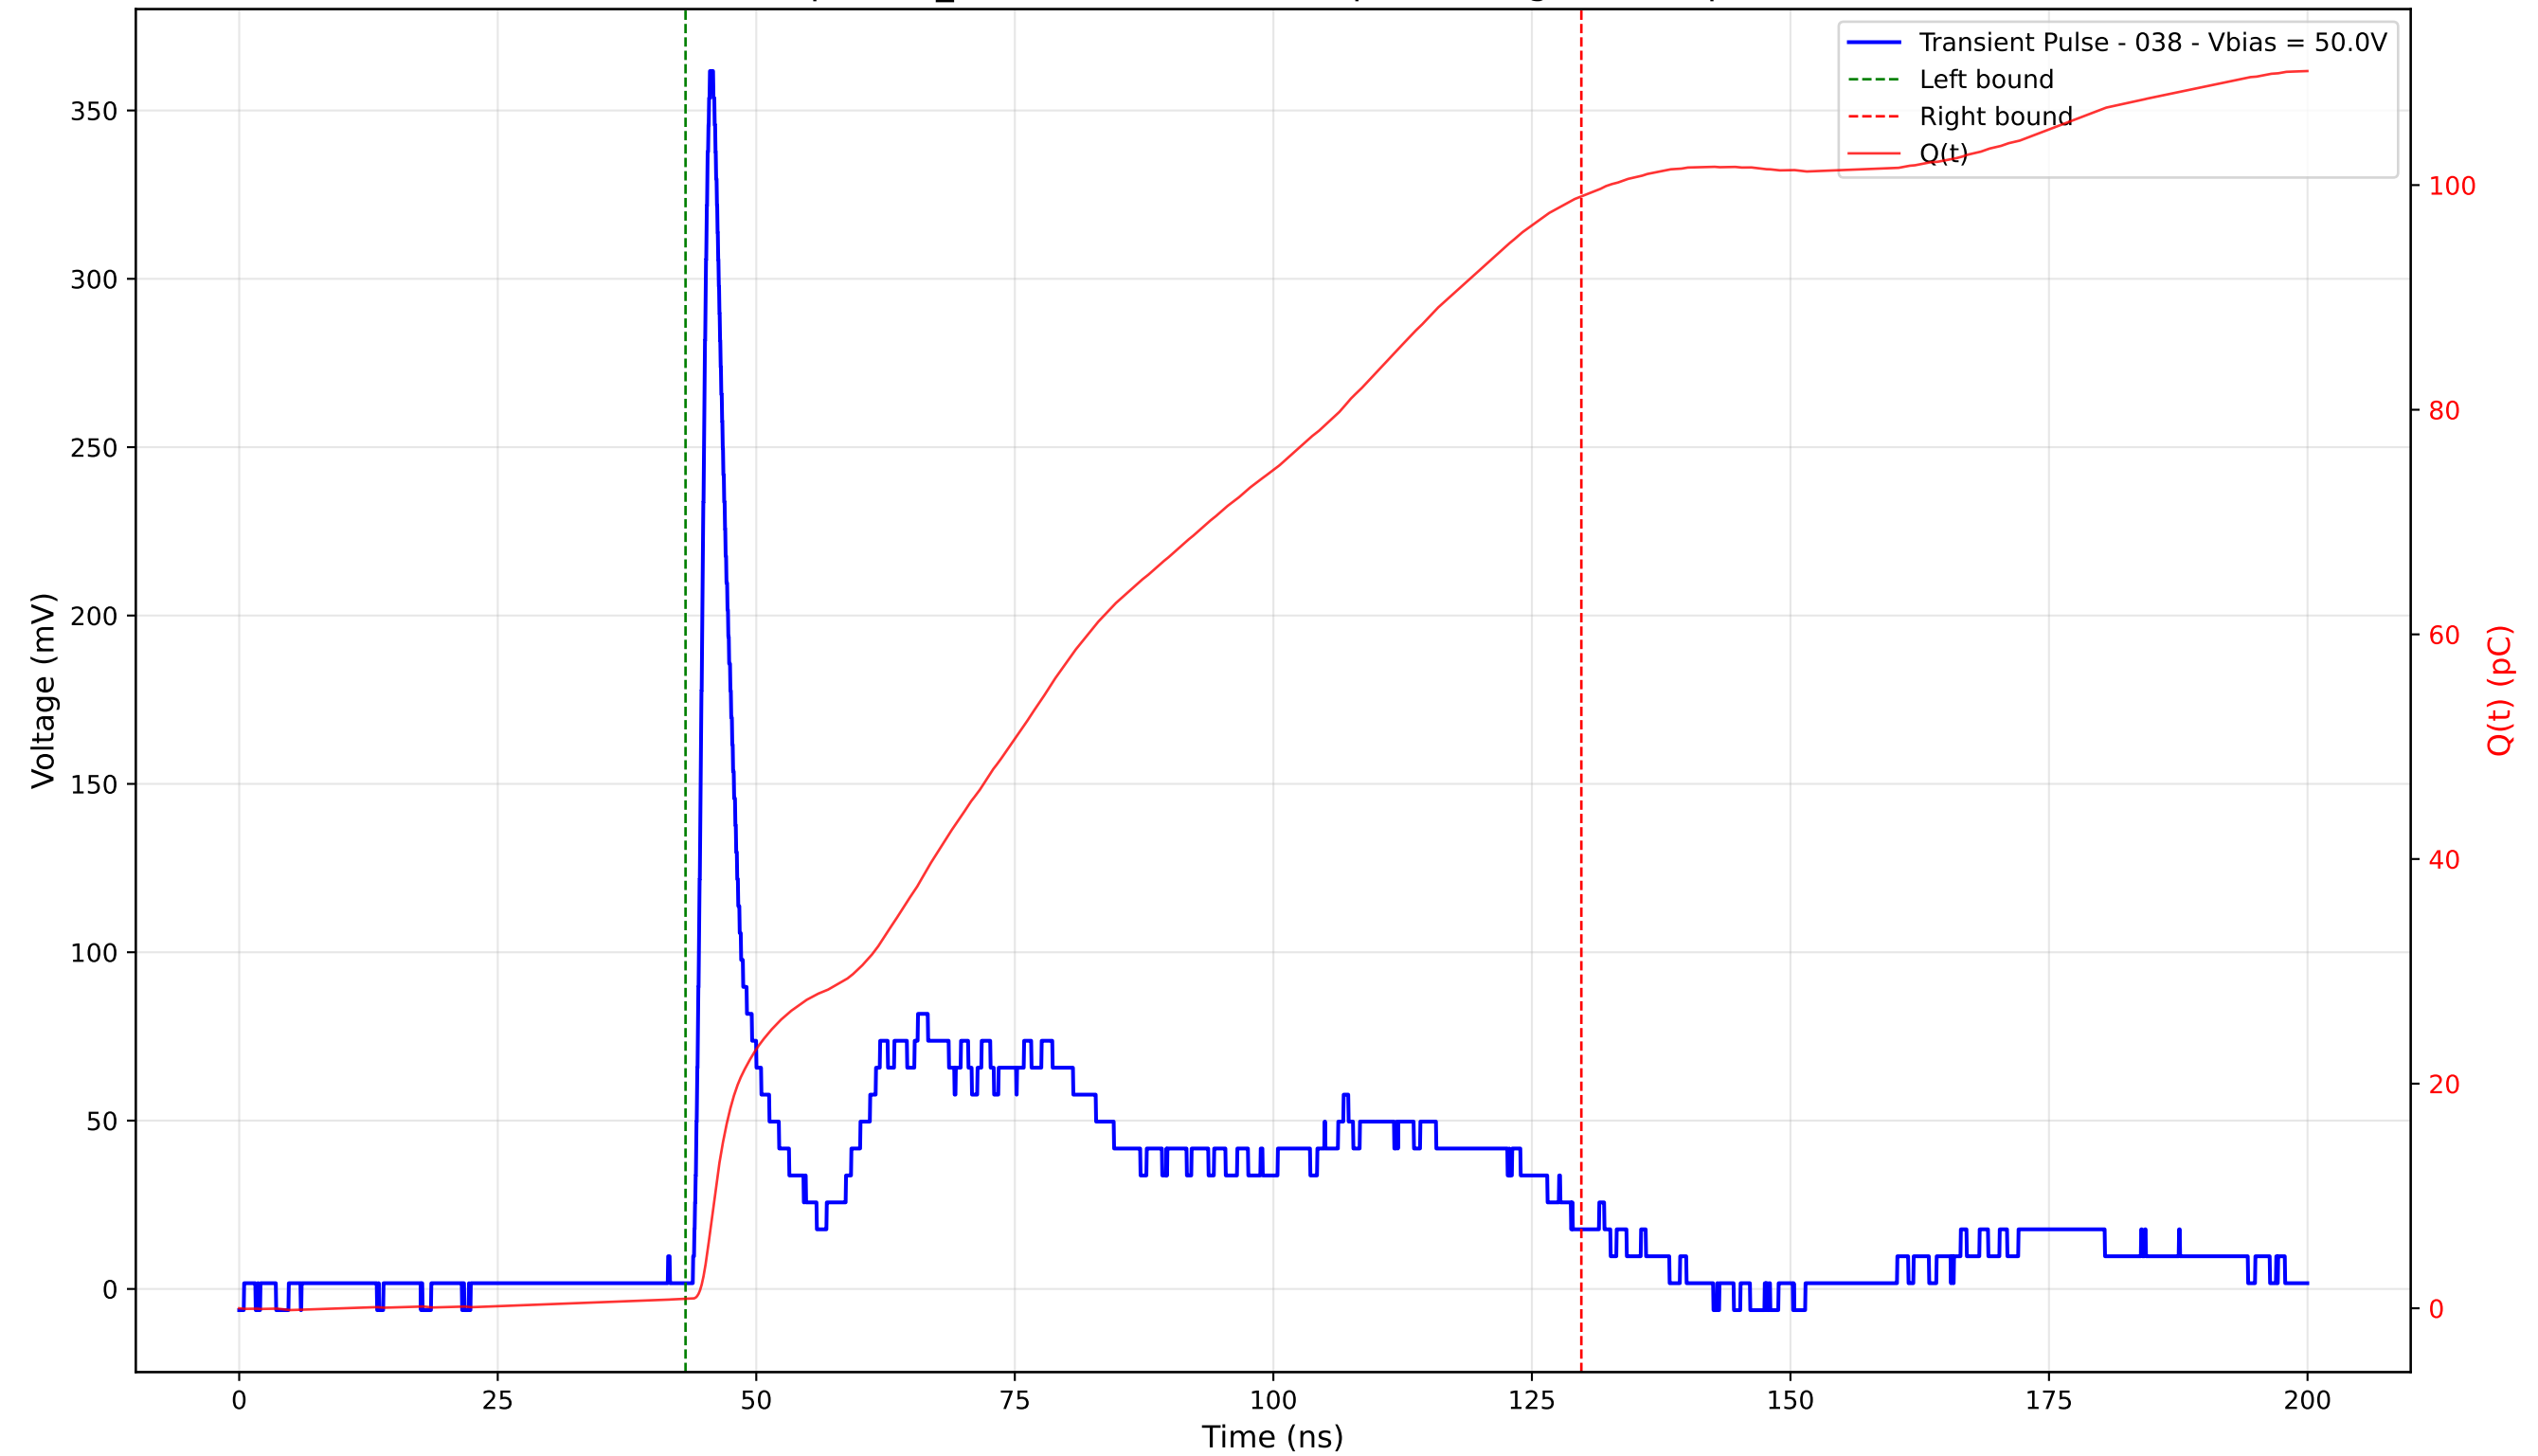


Transient Pulse - Sample: TD_4004 - Position: 140.0 μm - Charge: 90.58 pC - Rise Time: 1.15 ns

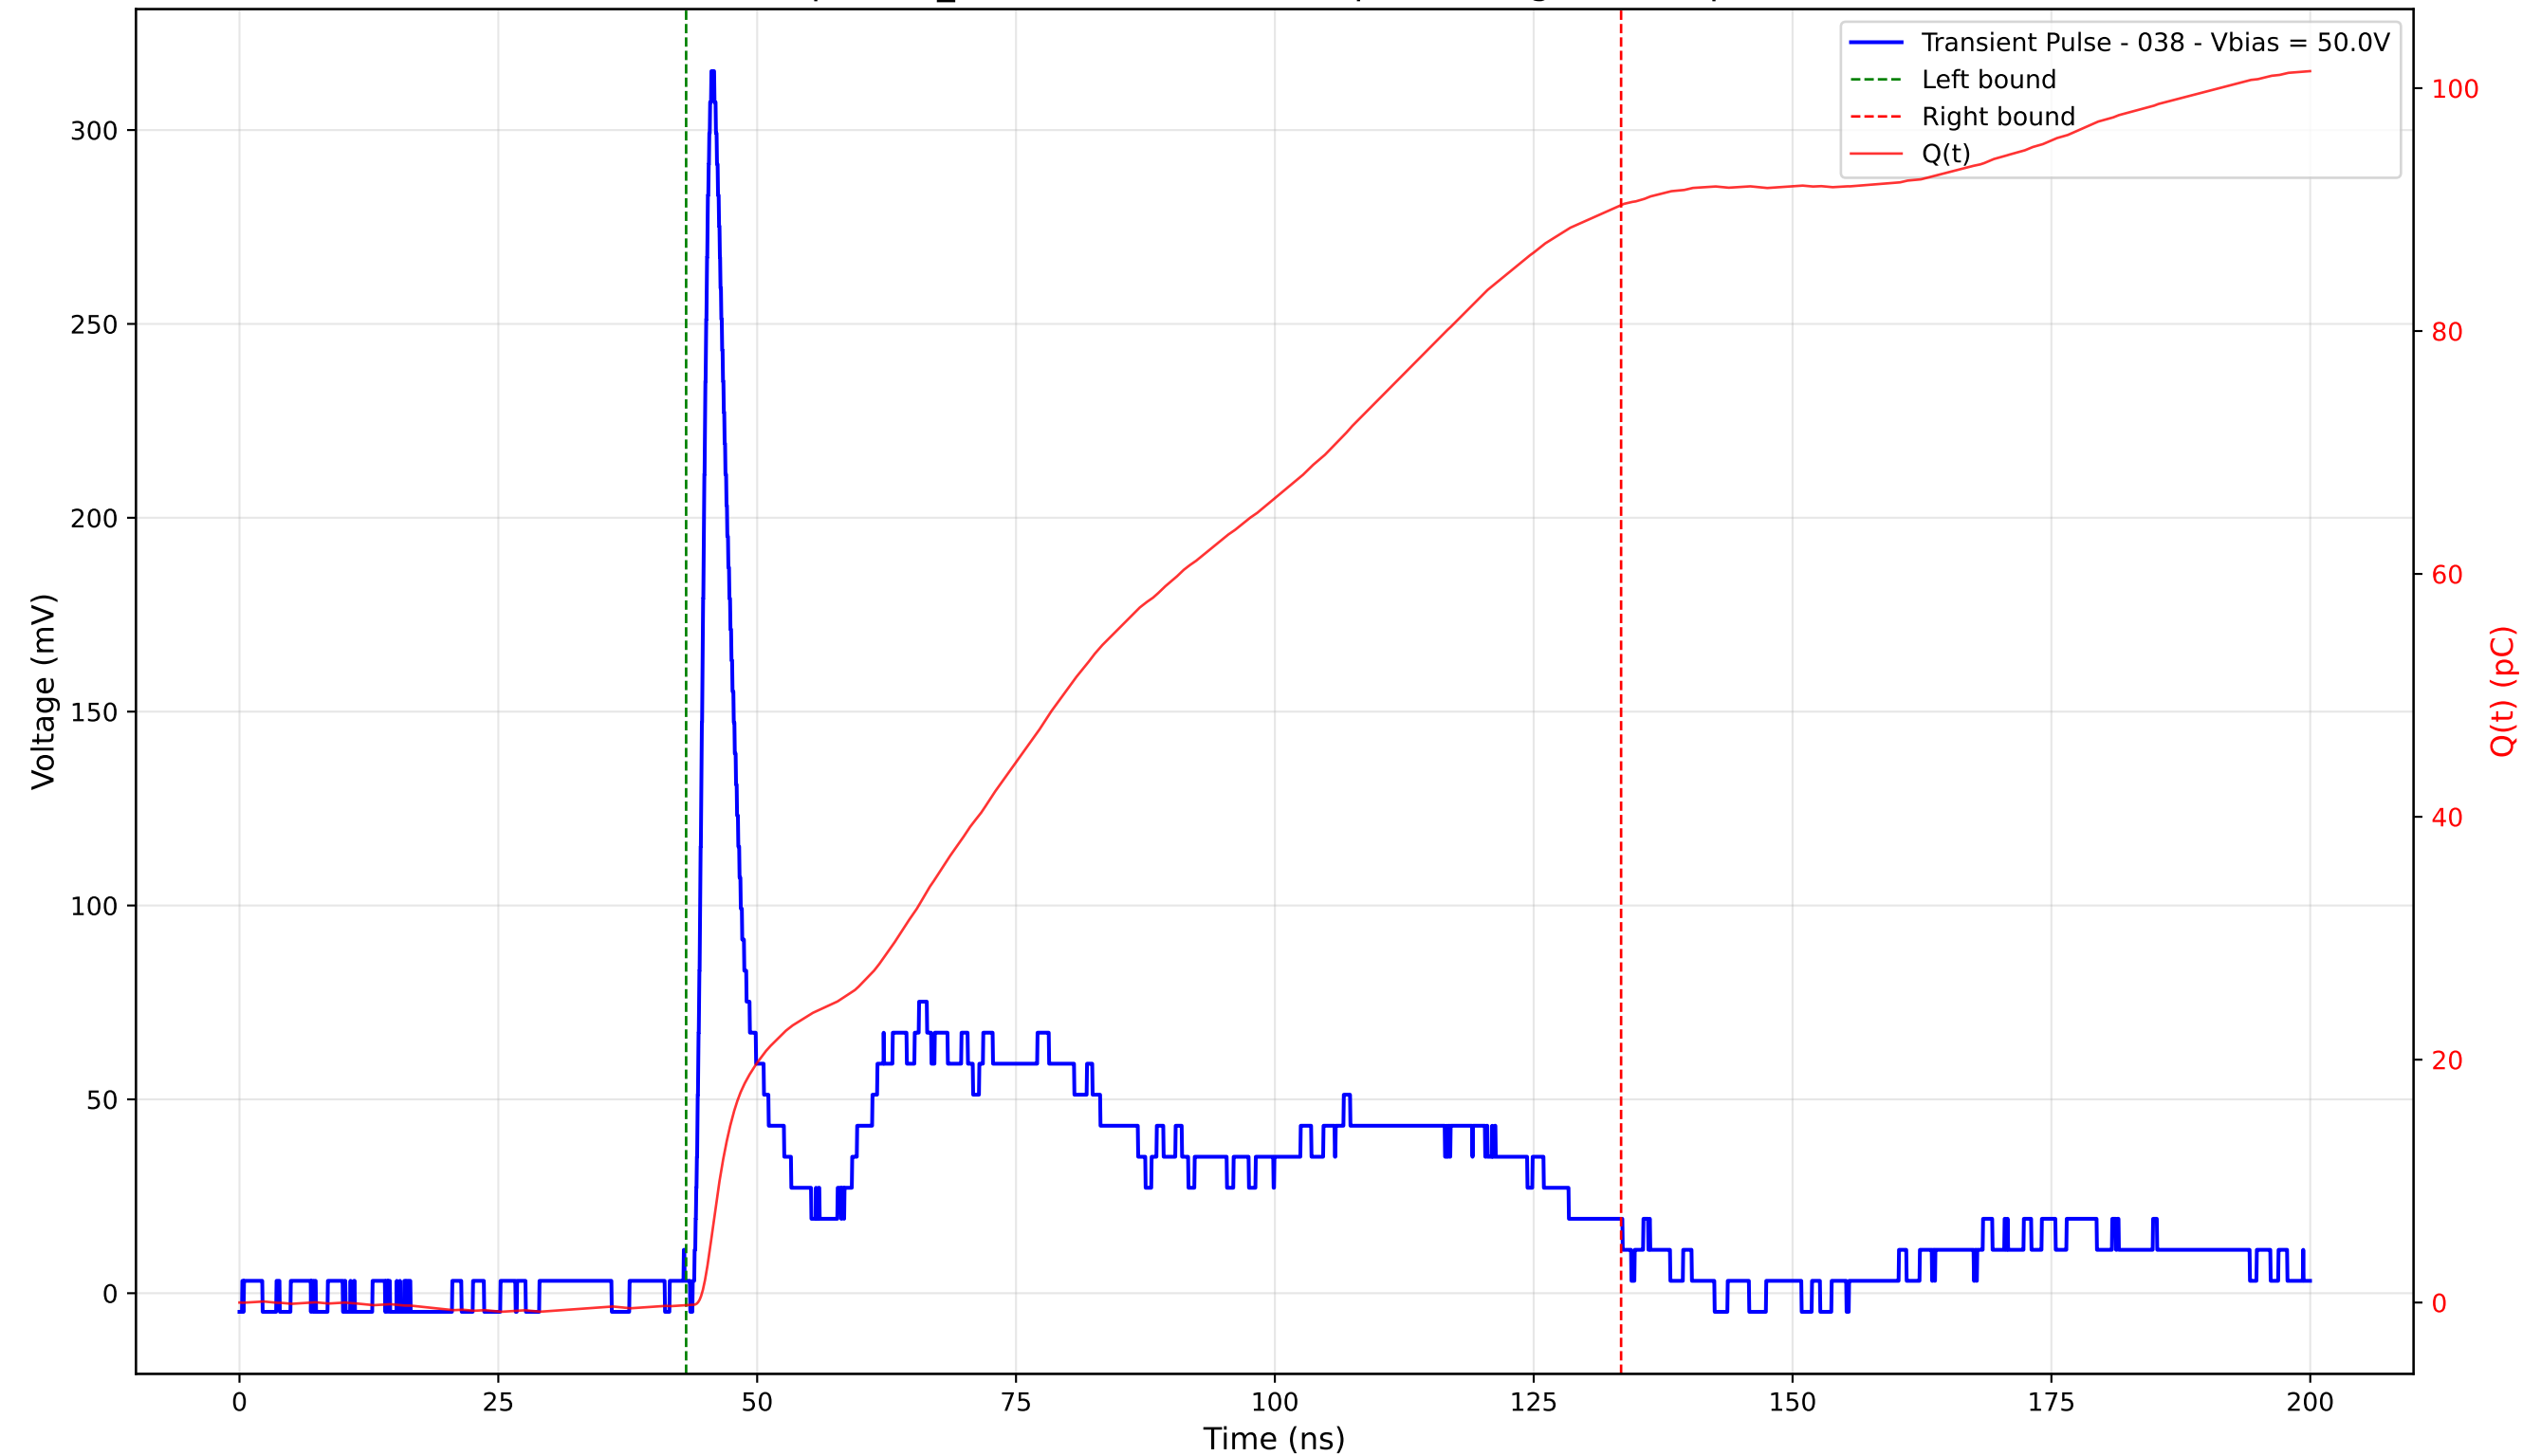


Transient Pulse - Sample: TD_4004 - Position: 145.0 μm - Charge: 91.61 pC - Rise Time: 1.14 ns

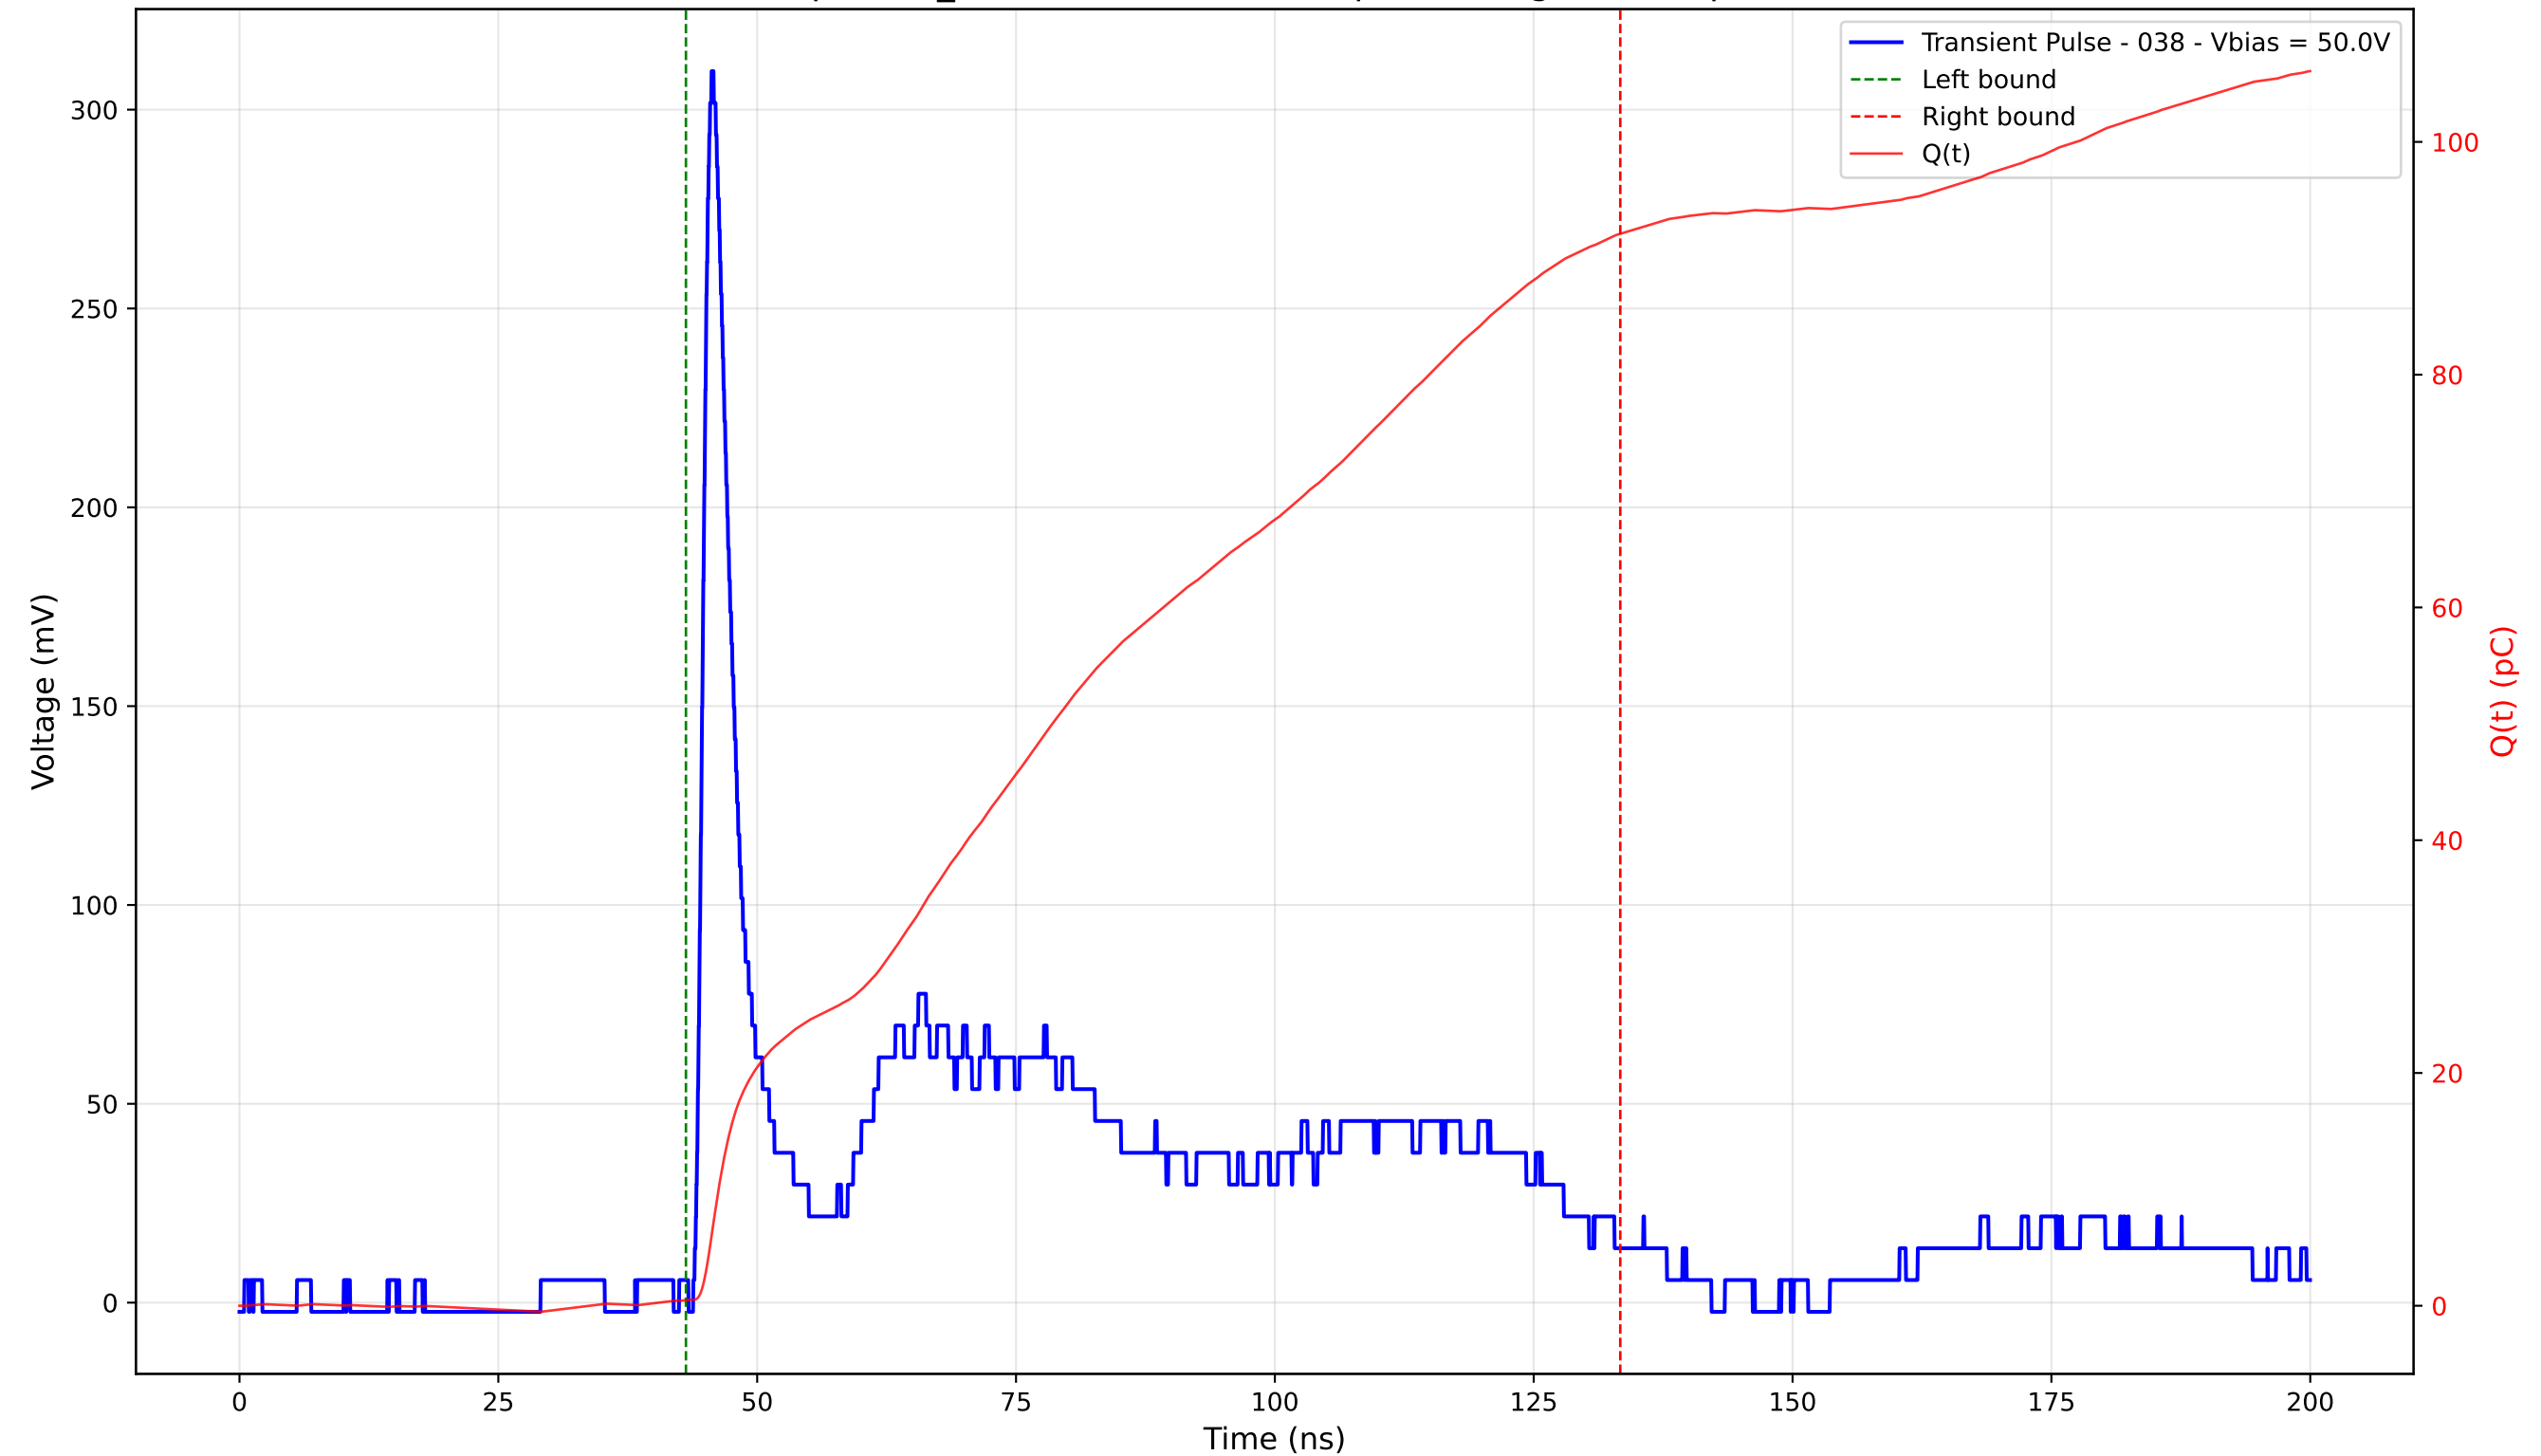


Transient Pulse - Sample: TD_4004 - Position: 150.0 μm - Charge: 91.93 pC - Rise Time: 1.15 ns

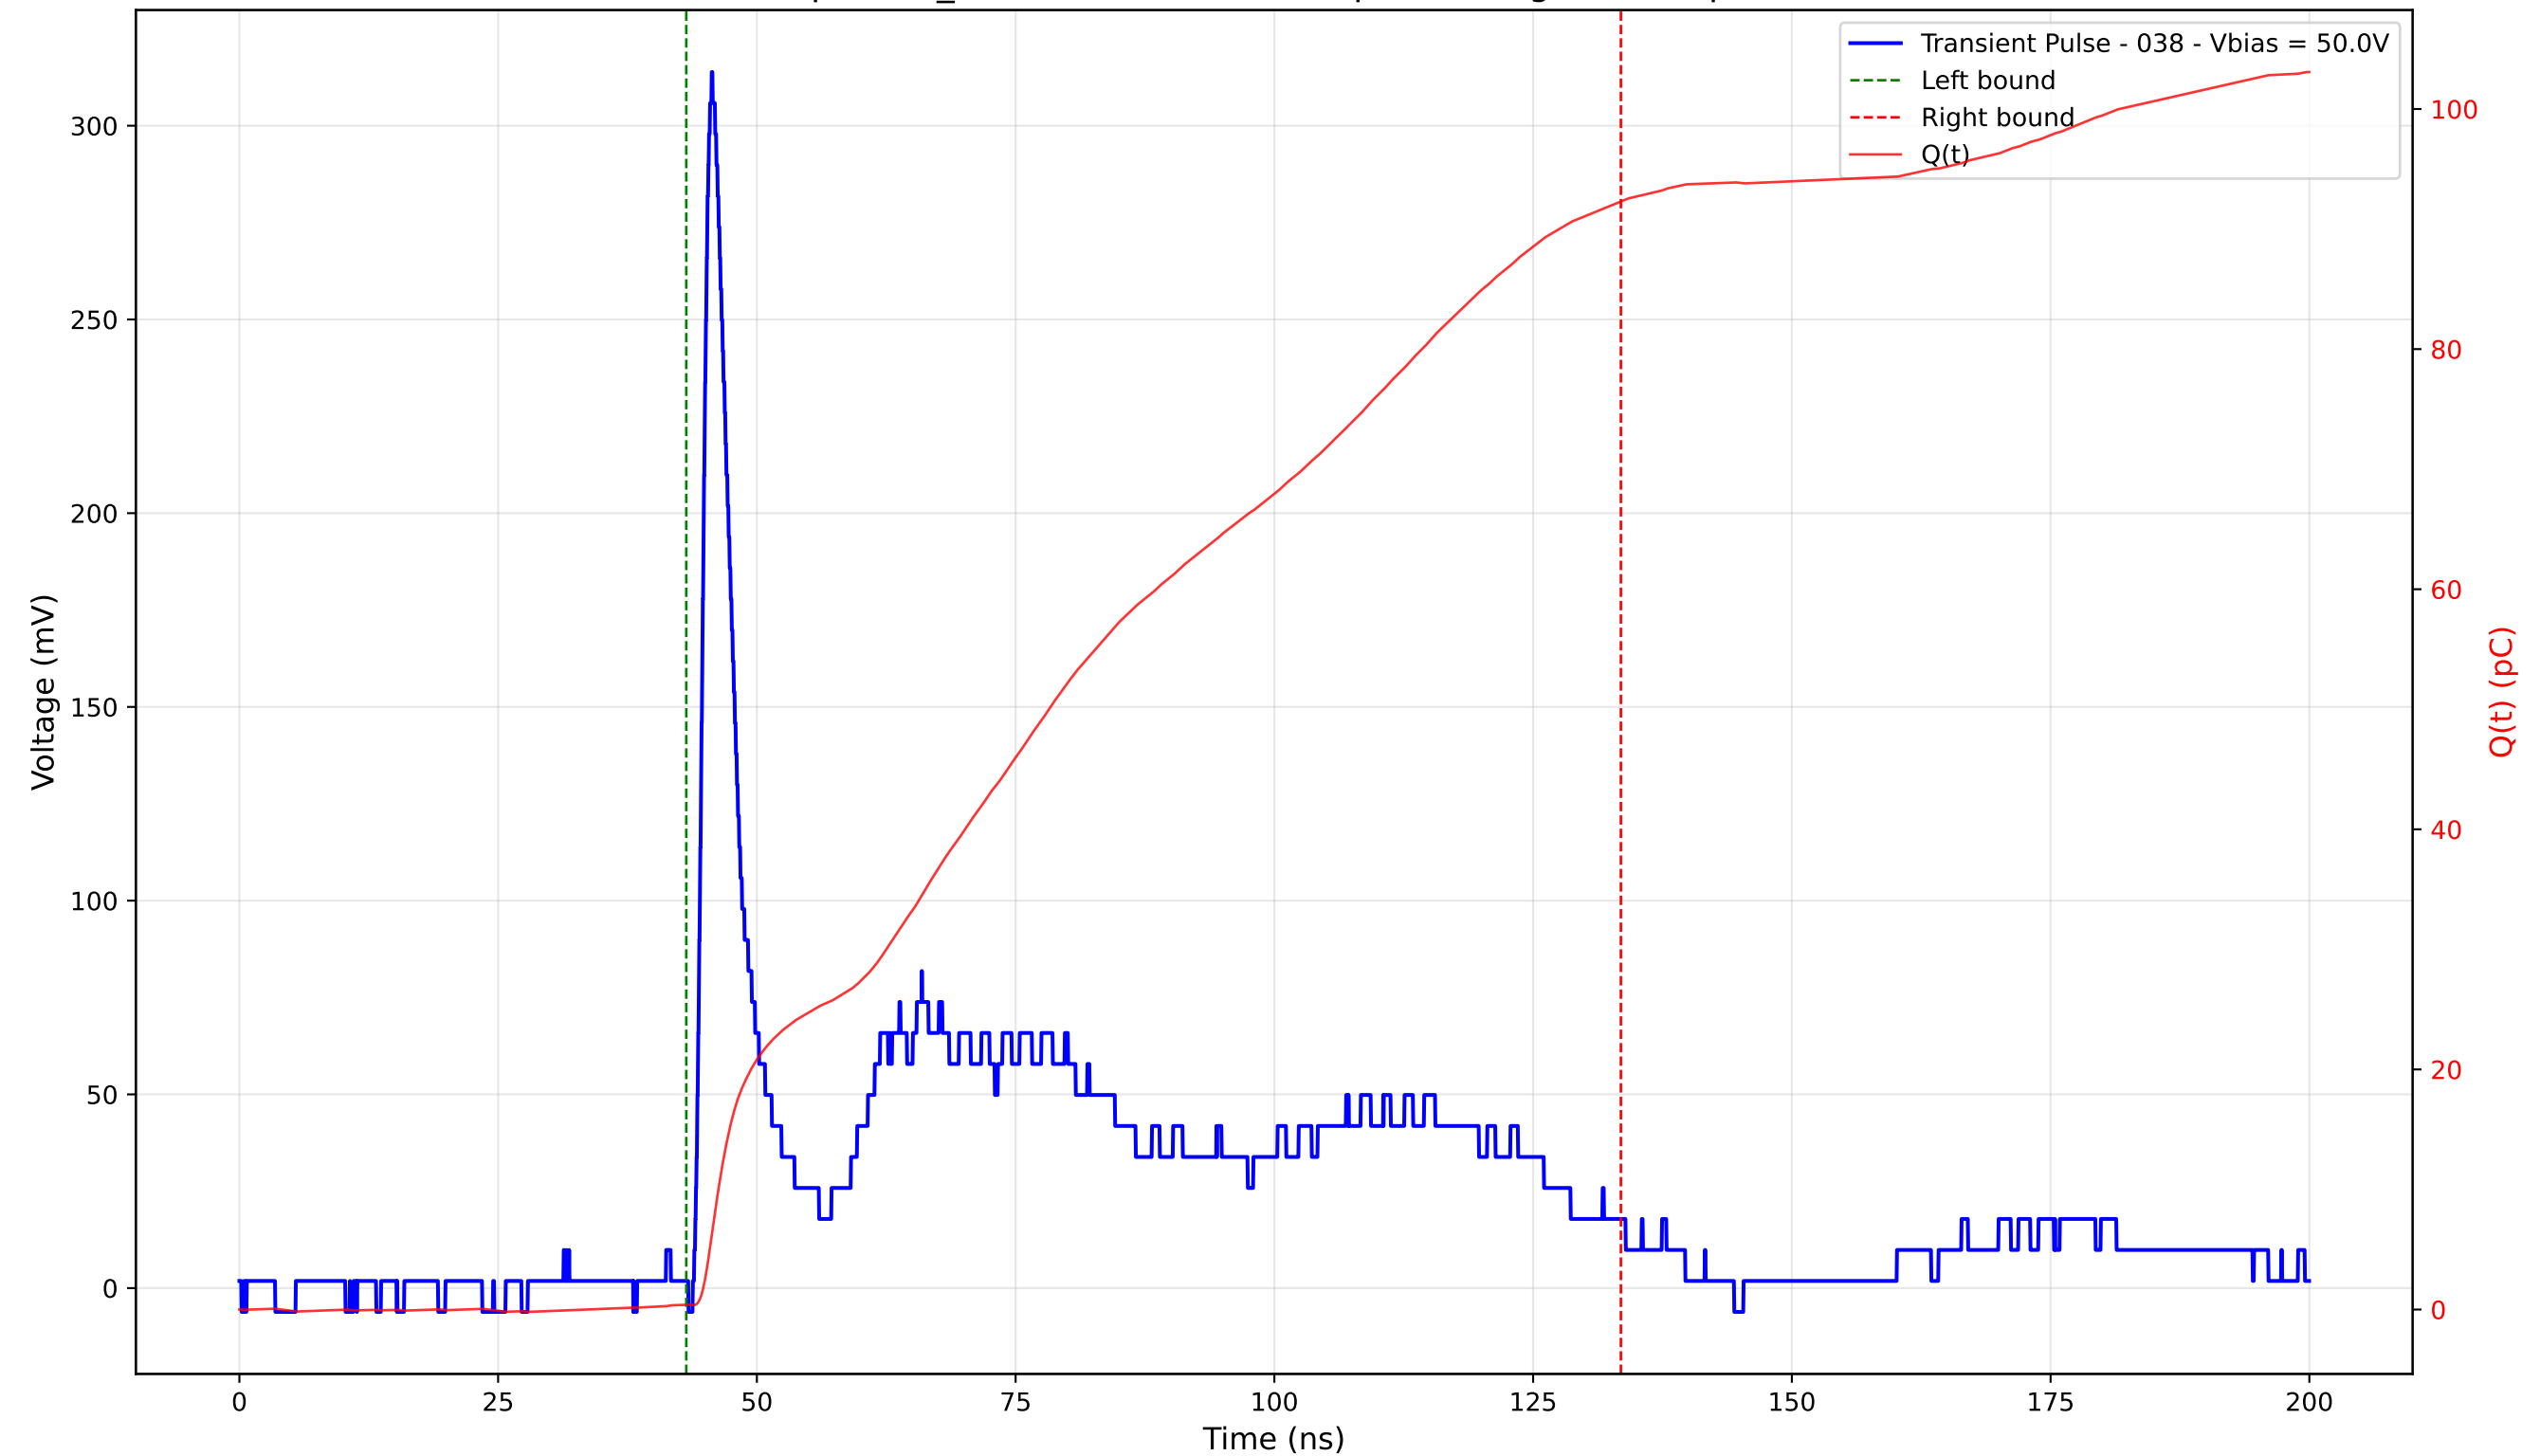


Transient Pulse - Sample: TD_4004 - Position: 155.0 μm - Charge: 96.00 pC - Rise Time: 1.12 ns

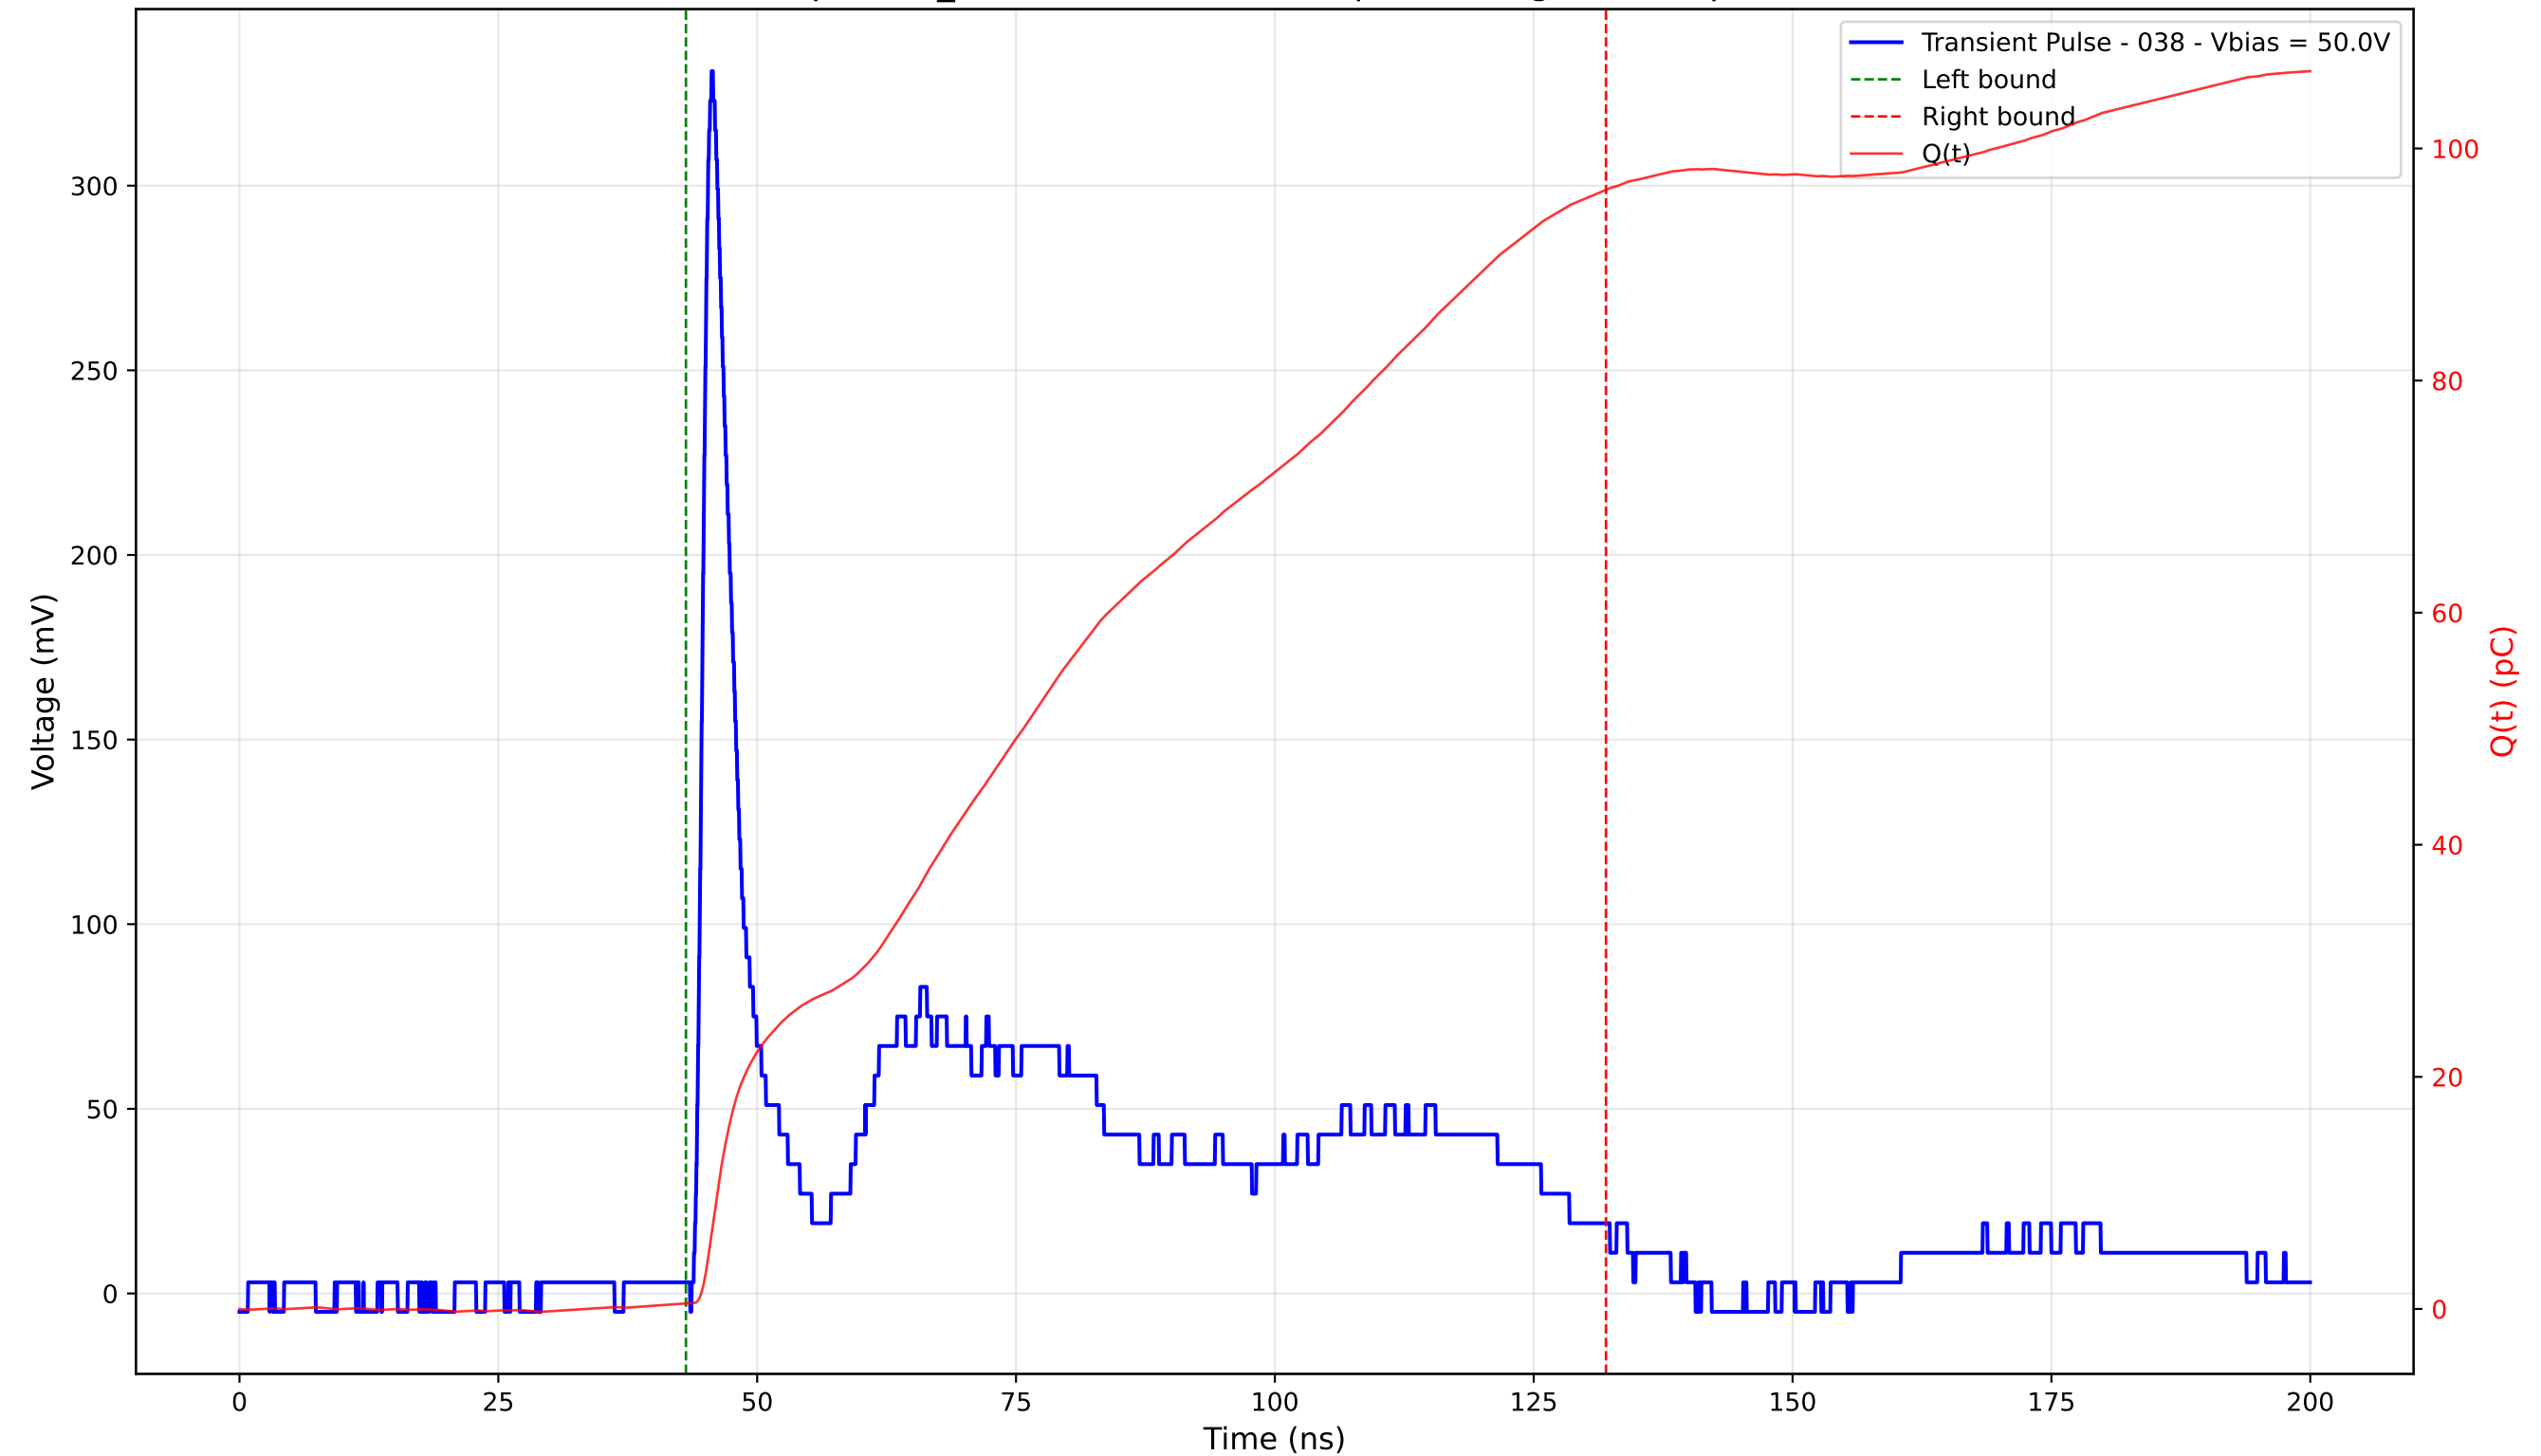


Transient Pulse - Sample: TD_4004 - Position: 160.0 μm - Charge: 103.82 pC - Rise Time: 1.07 ns

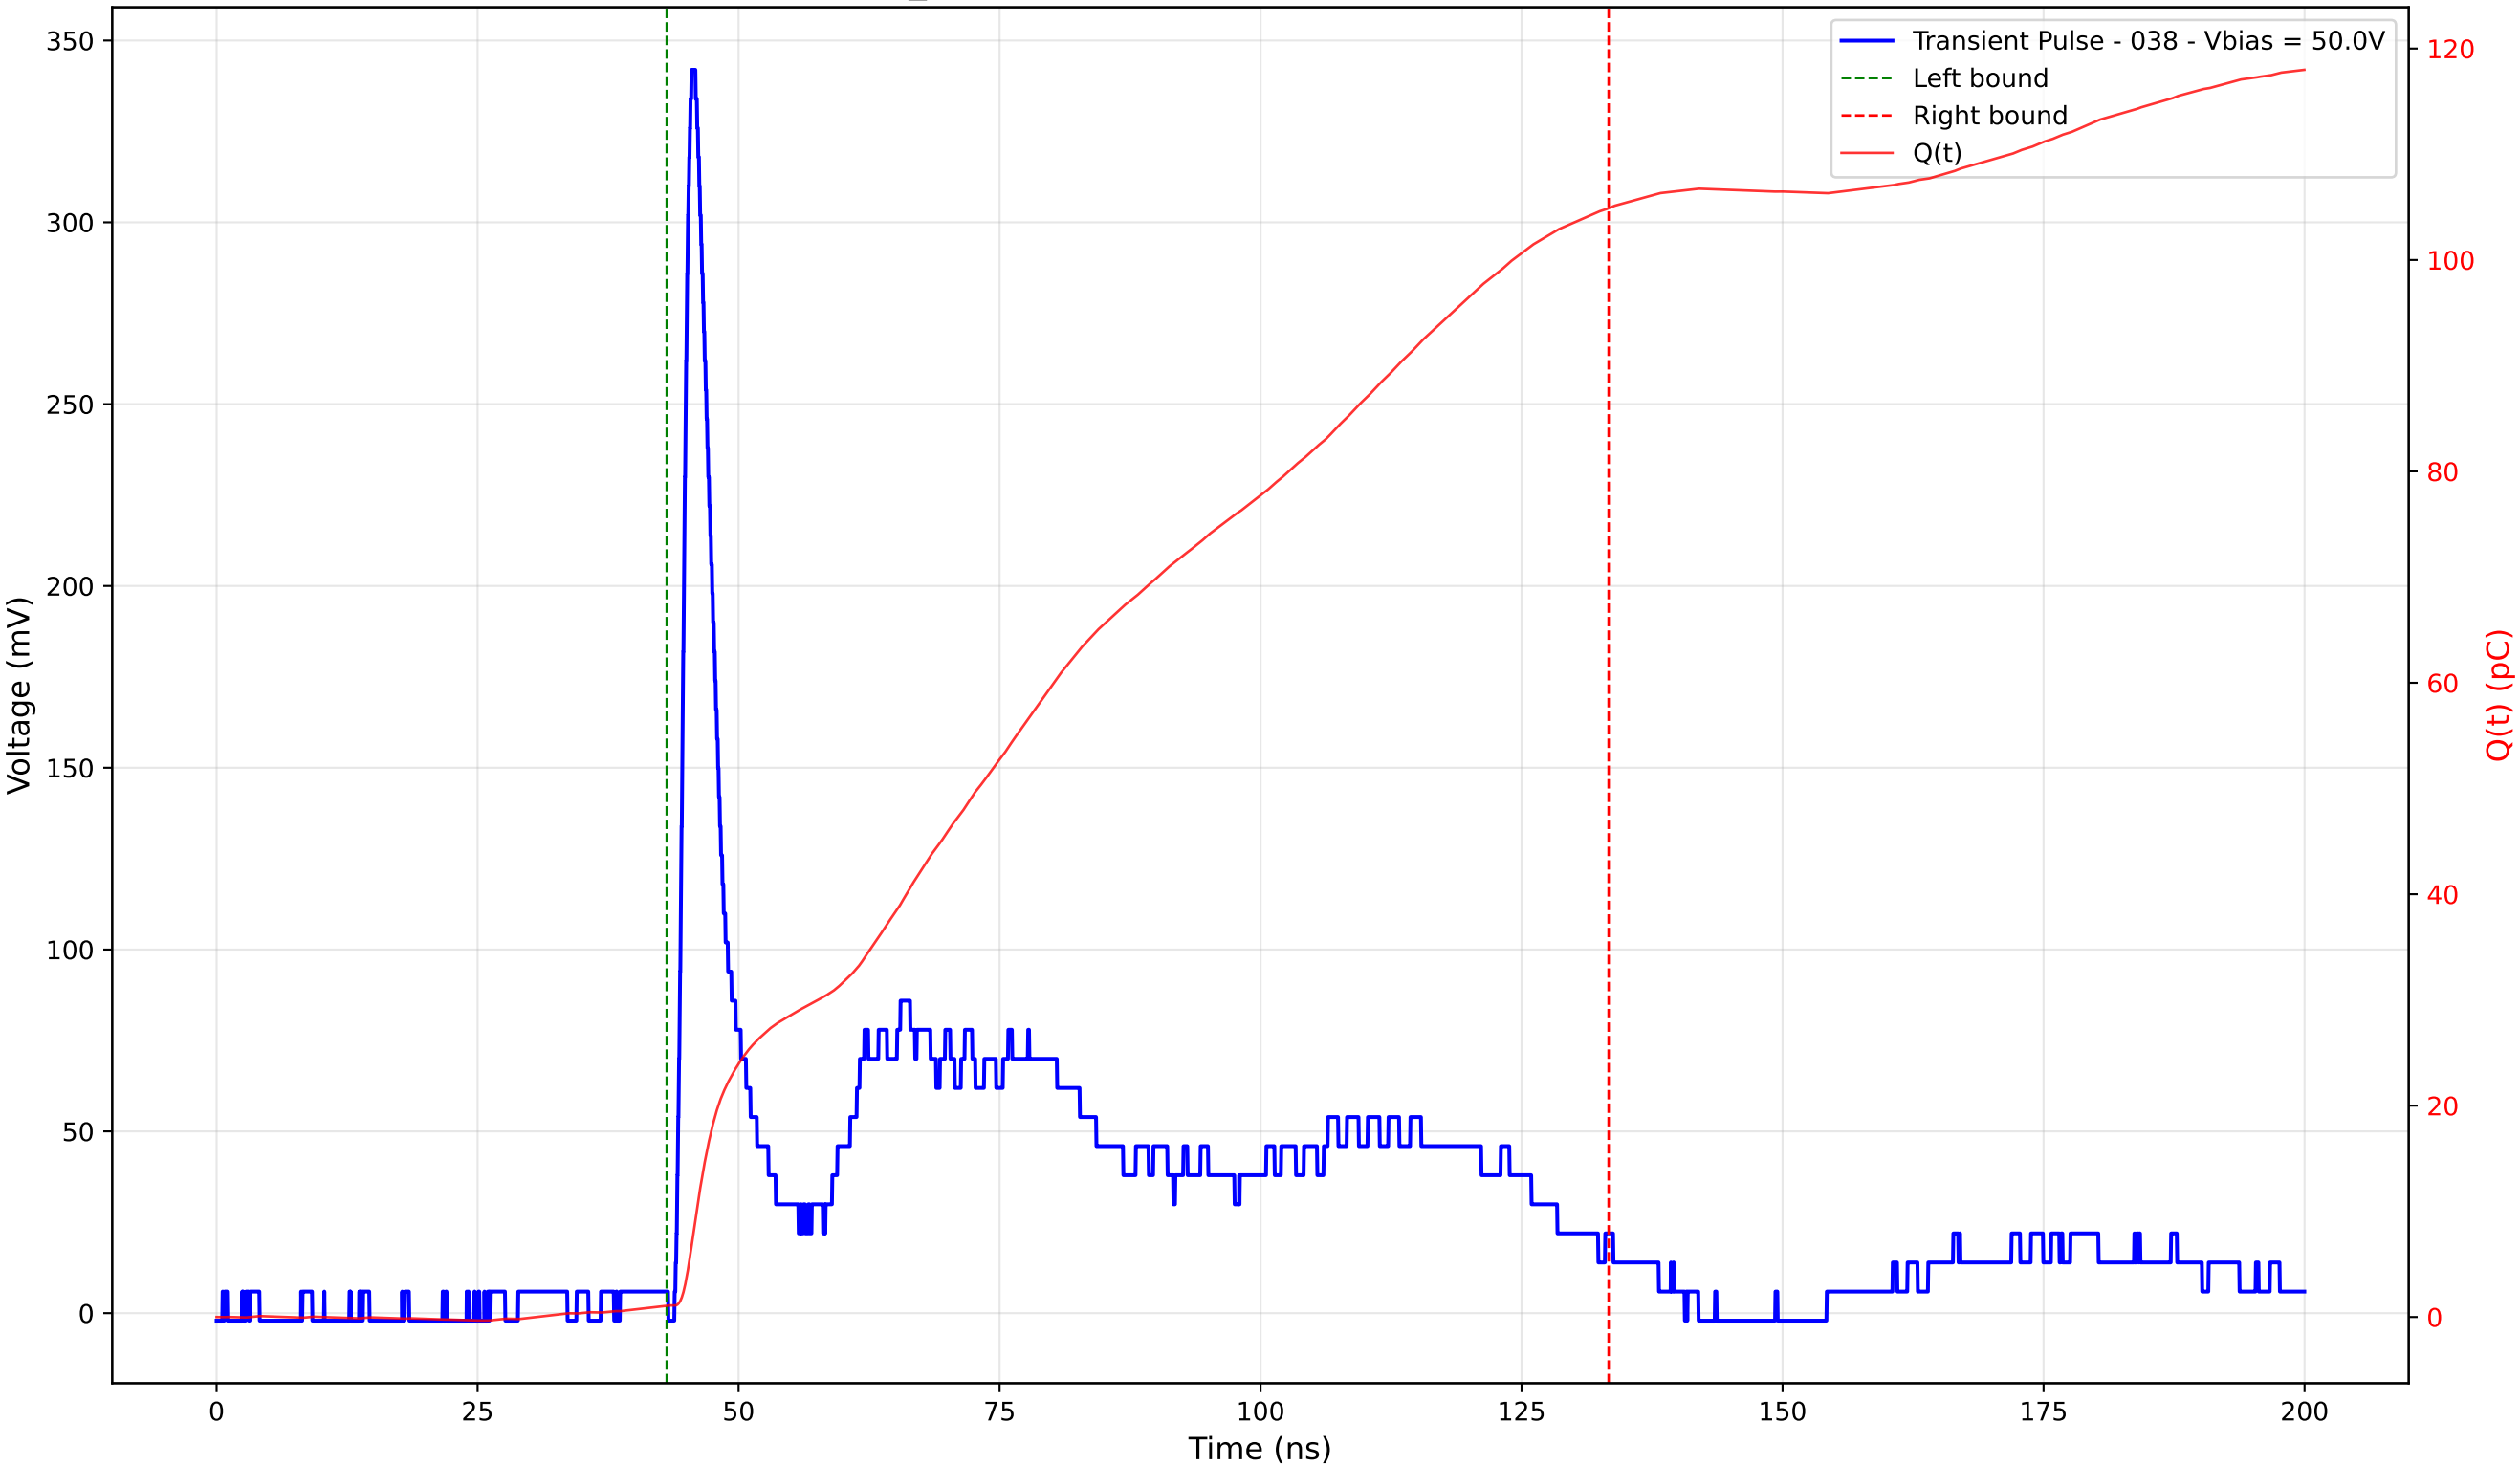


Transient Pulse - Sample: TD_4004 - Position: 165.0 μm - Charge: 111.05 pC - Rise Time: 1.09 ns

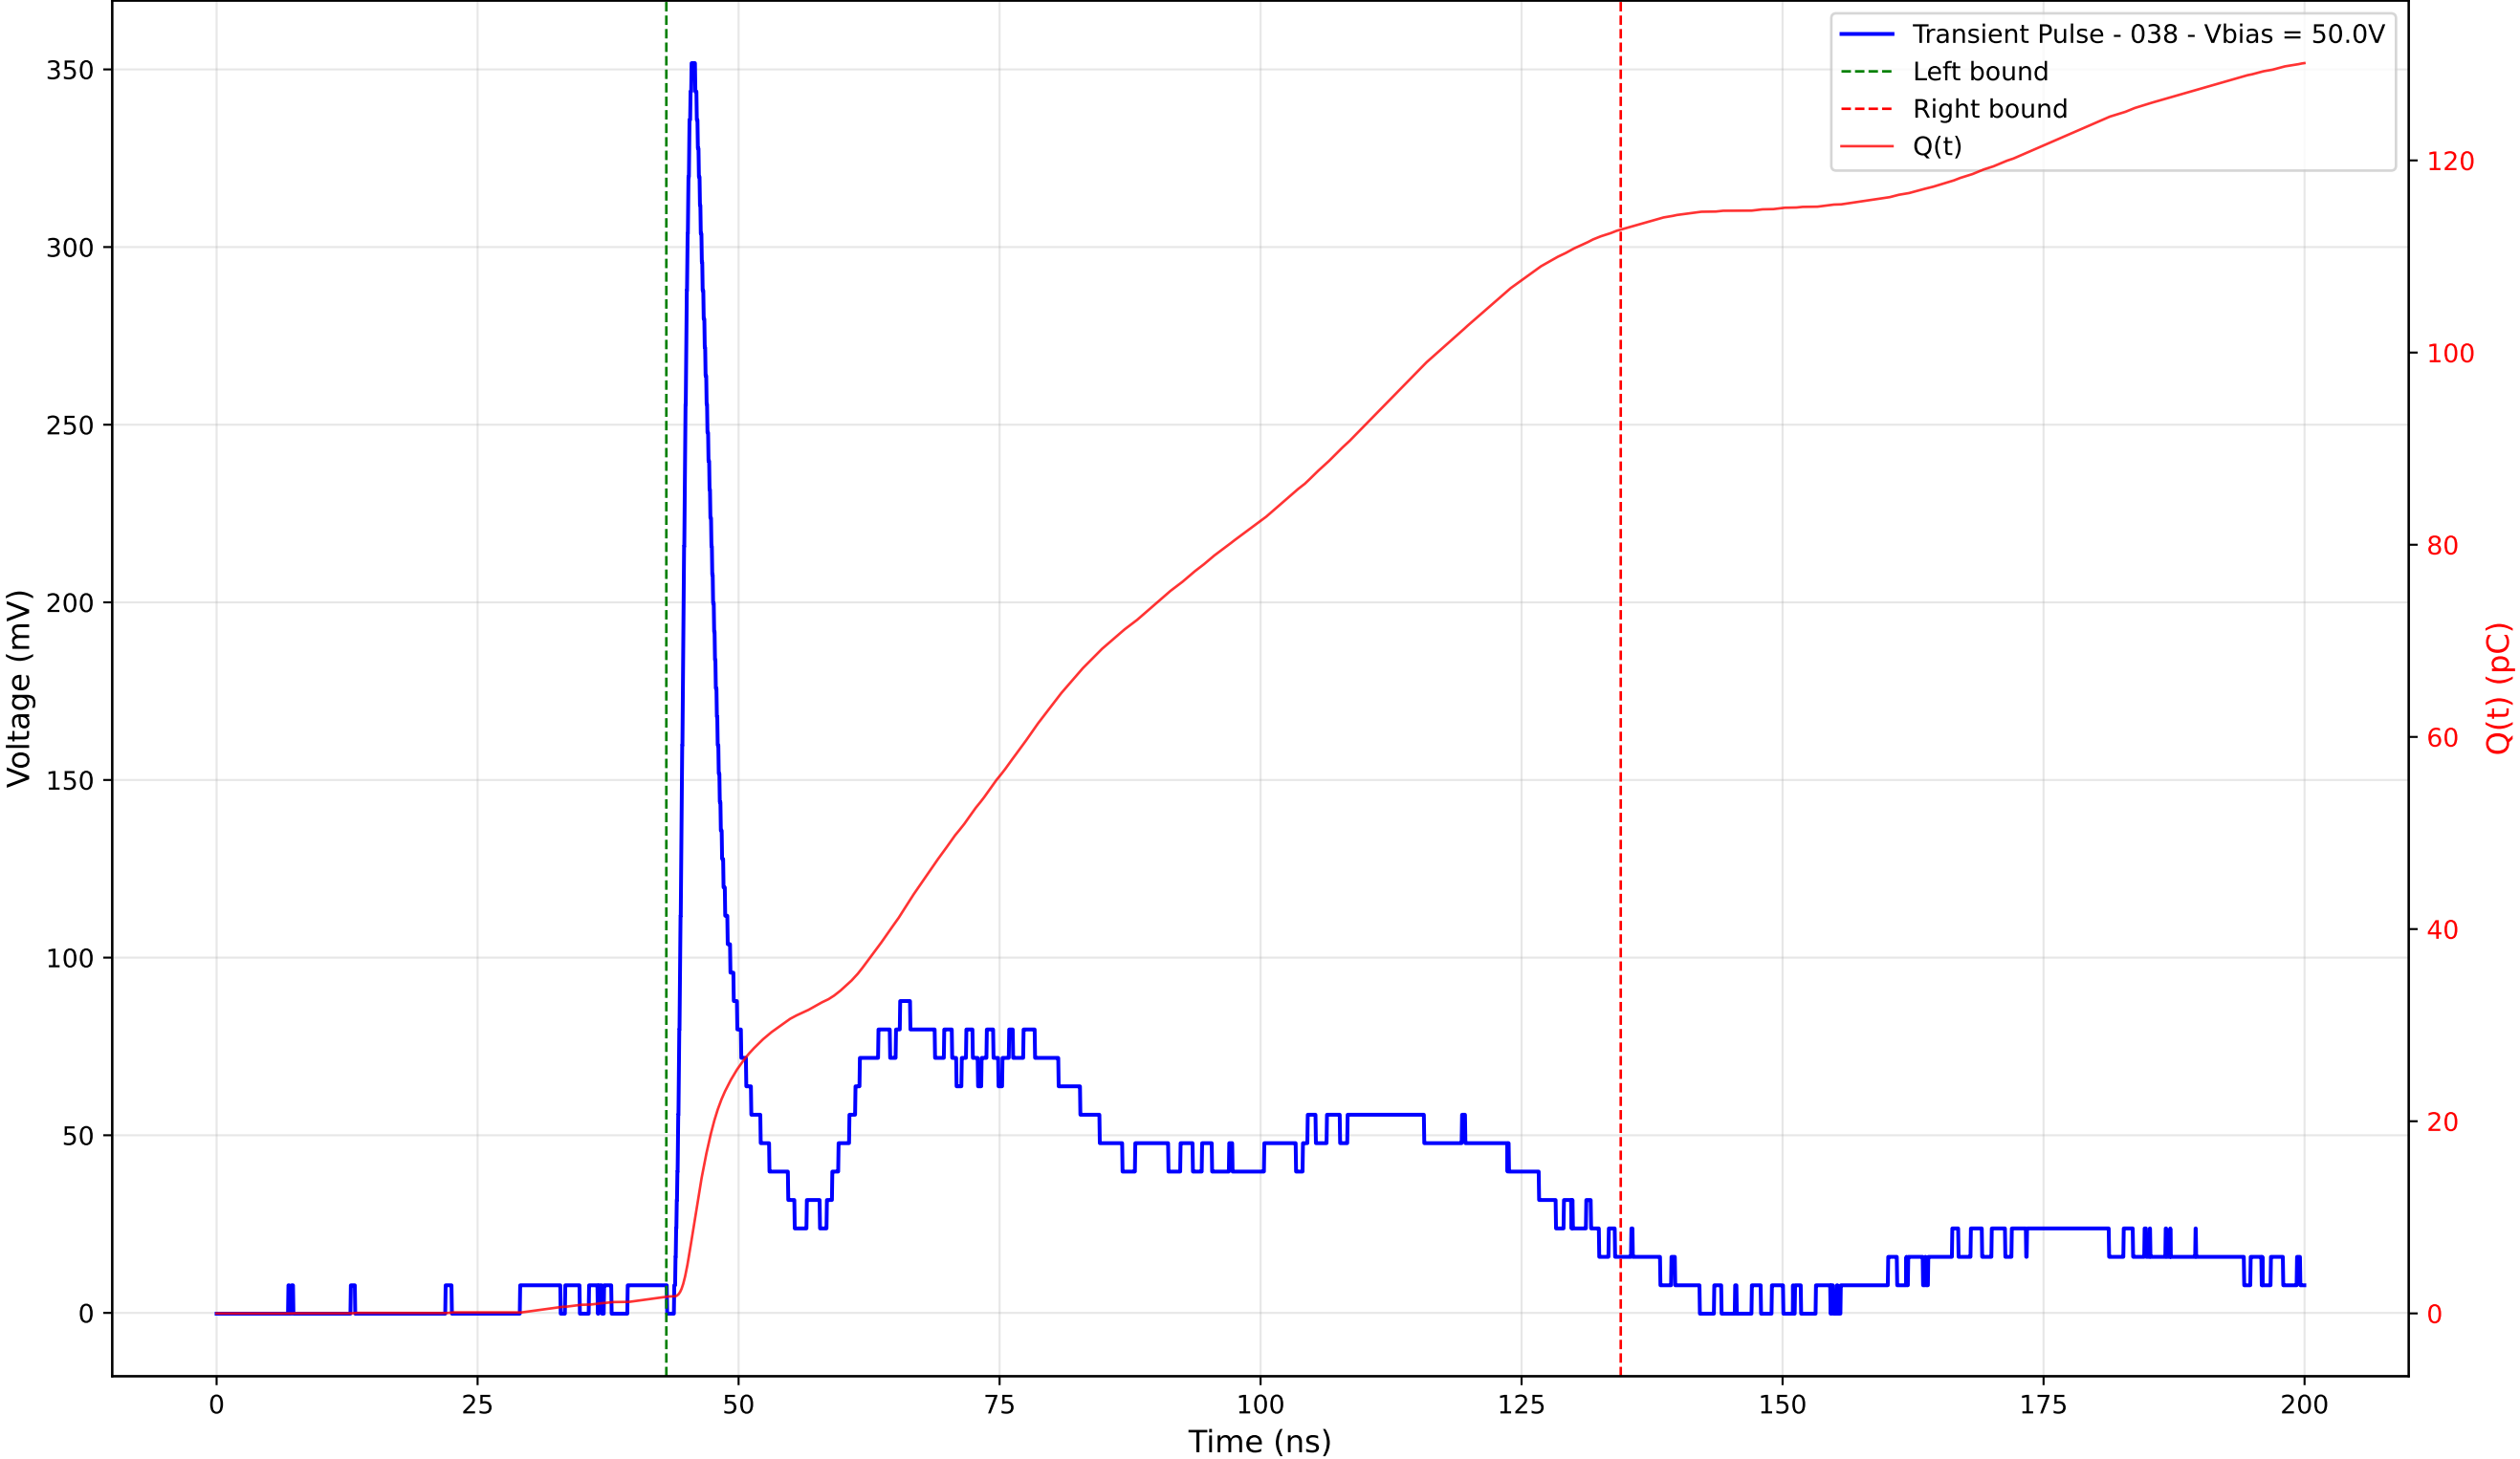


Transient Pulse - Sample: TD_4004 - Position: 170.0 μm - Charge: 113.90 pC - Rise Time: 1.09 ns

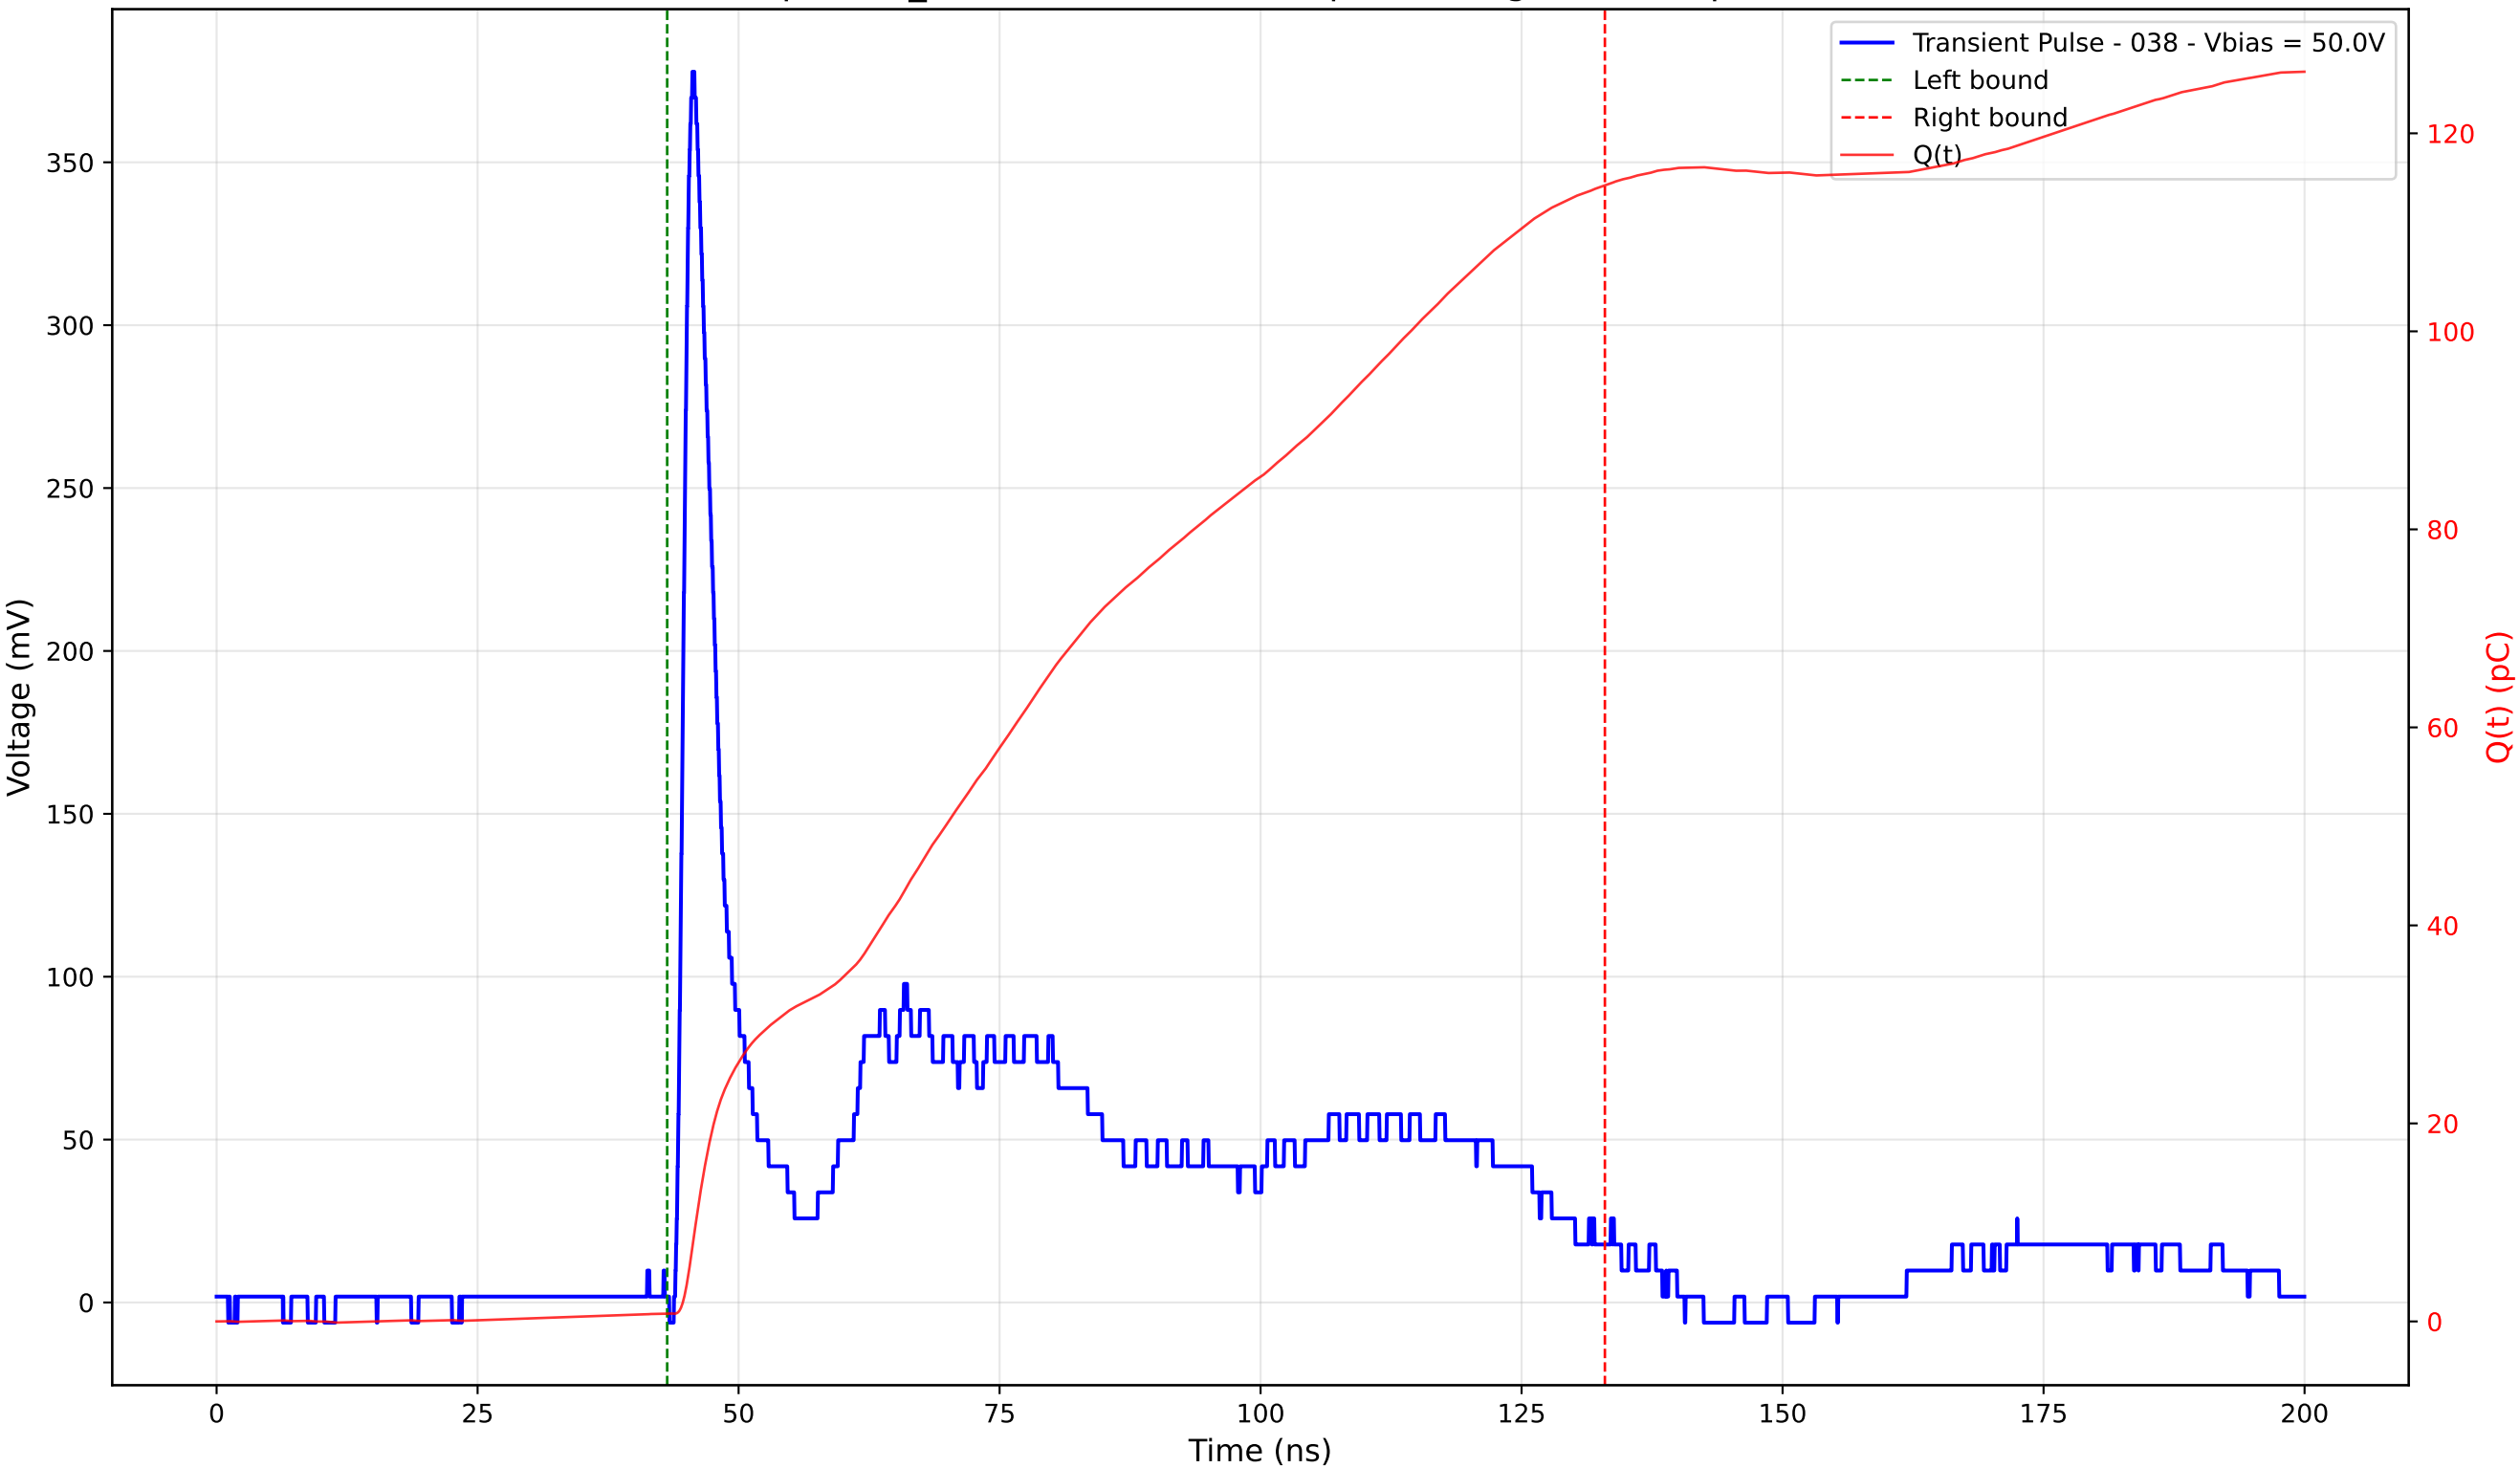


Transient Pulse - Sample: TD_4004 - Position: 175.0 μm - Charge: 124.50 pC - Rise Time: 1.05 ns

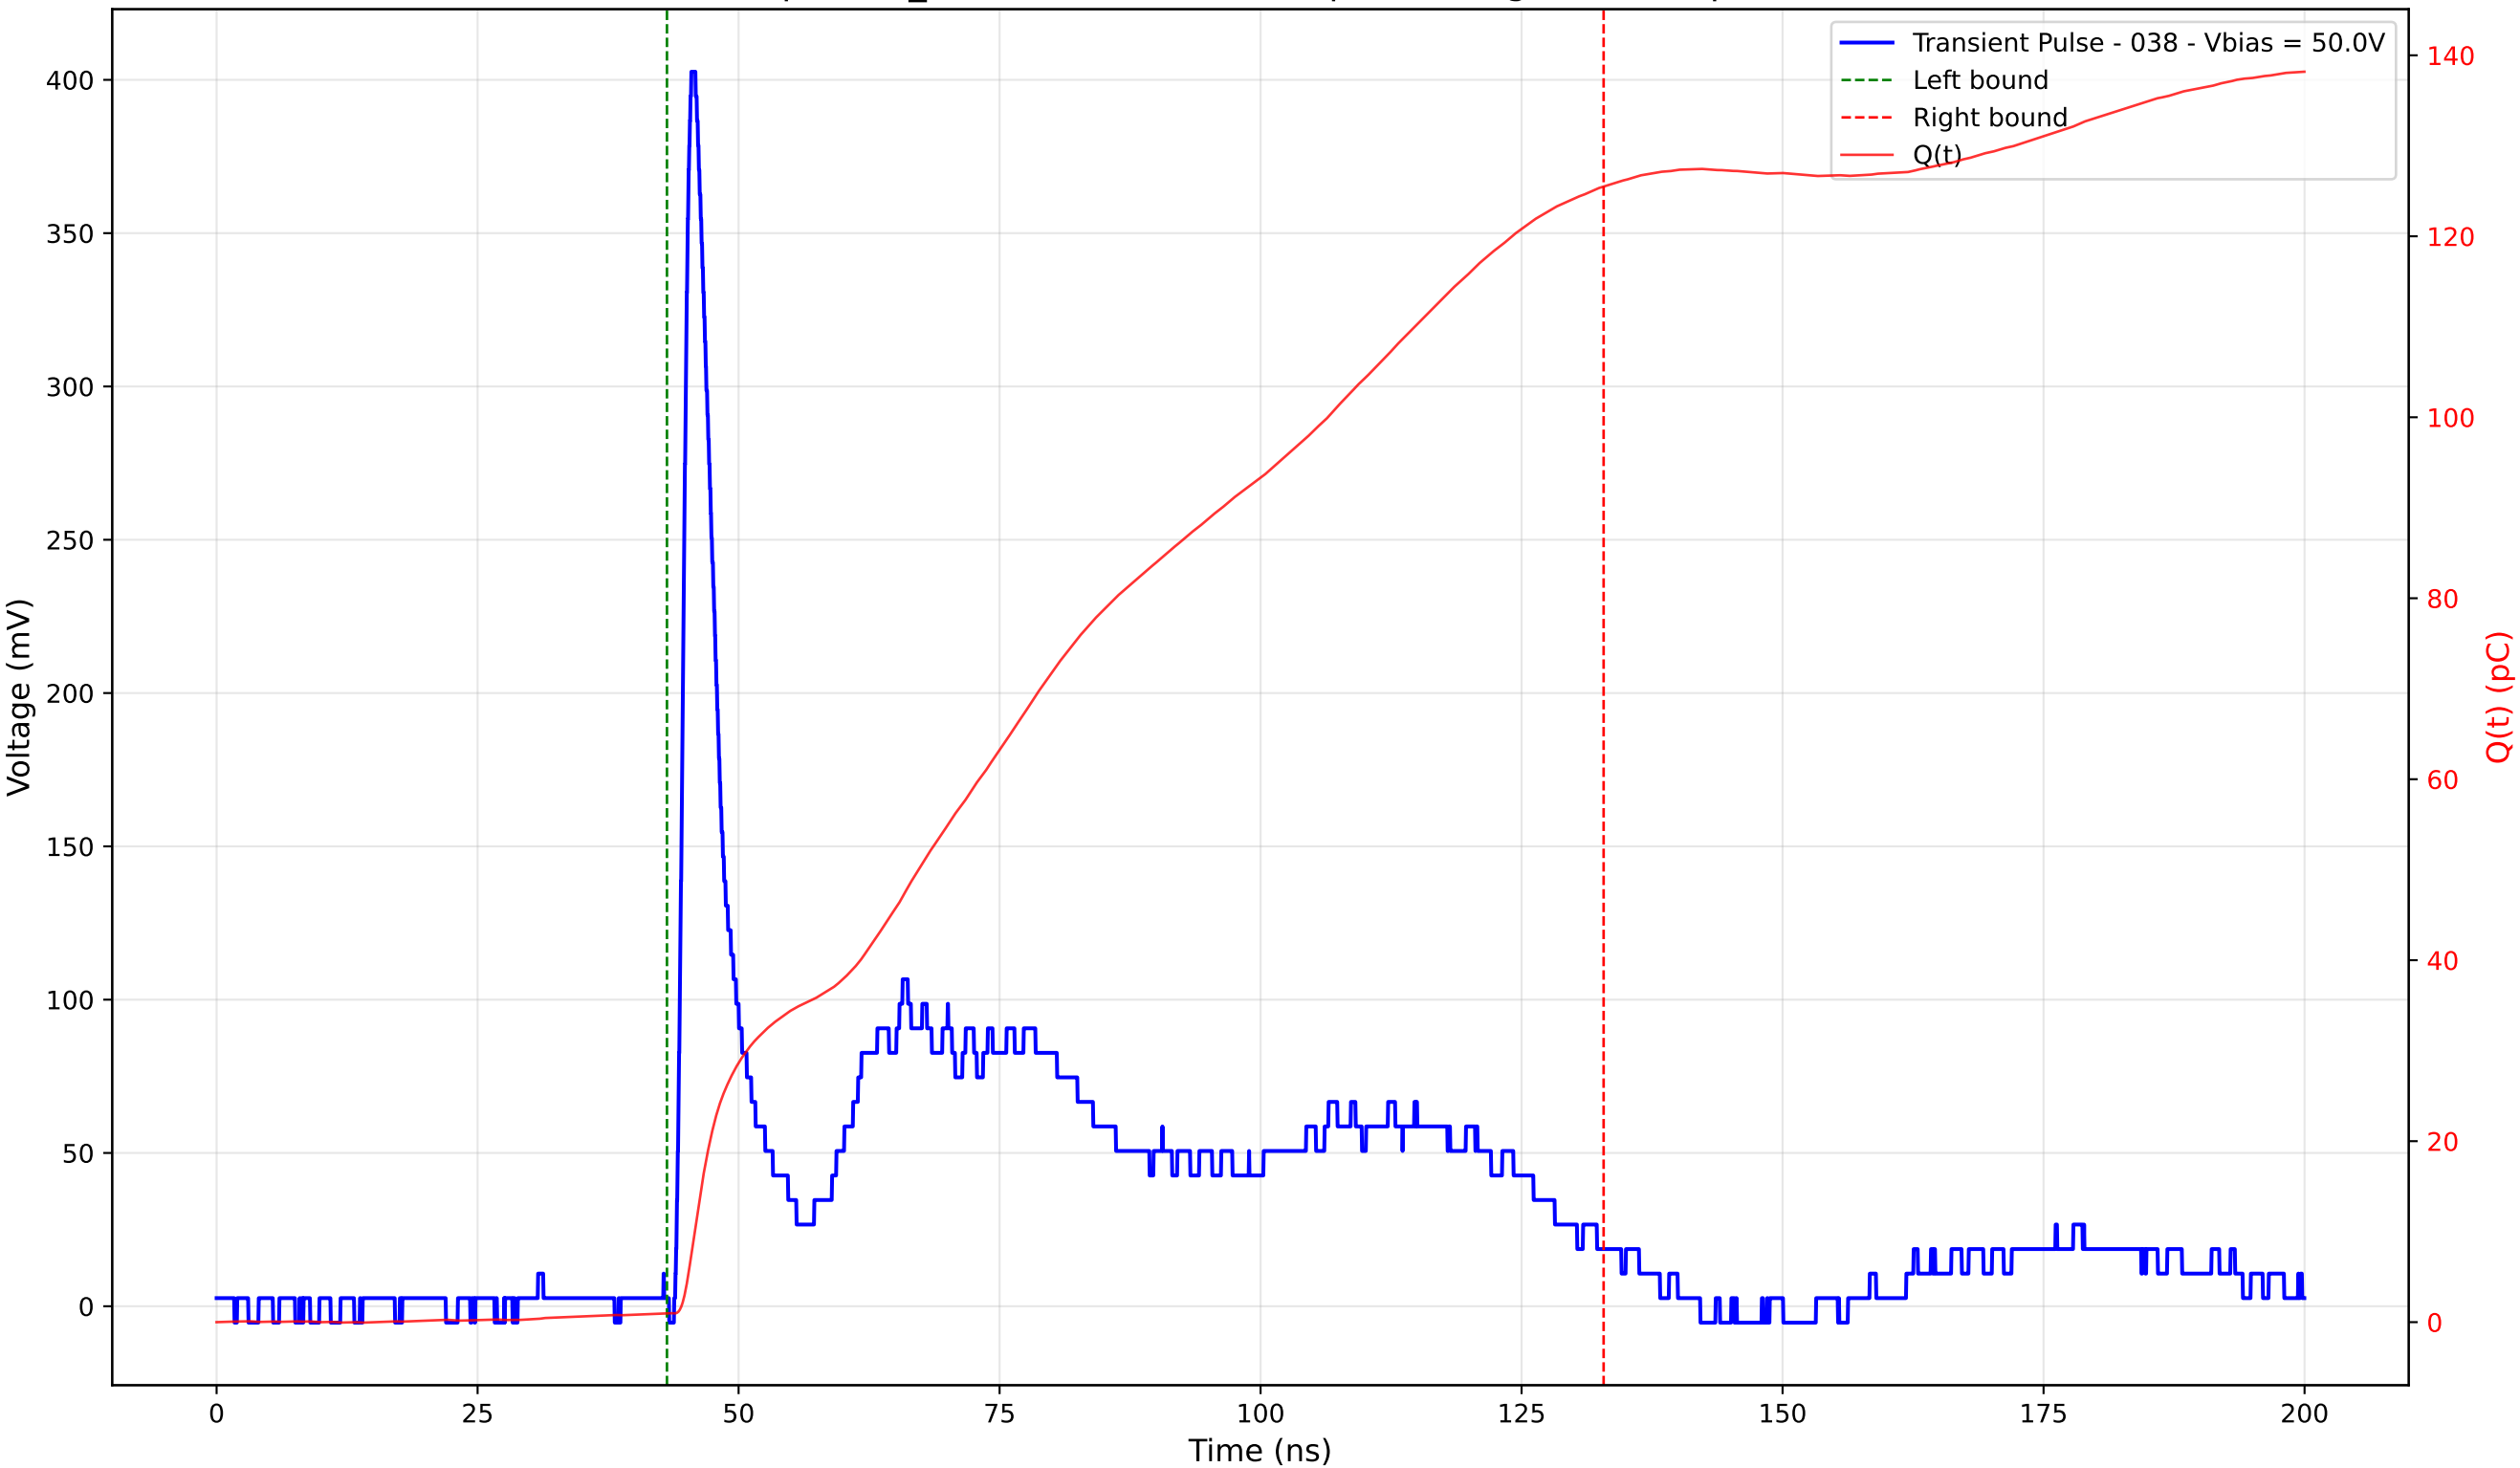


Transient Pulse - Sample: TD_4004 - Position: 180.0 μm - Charge: 131.47 pC - Rise Time: 1.08 ns

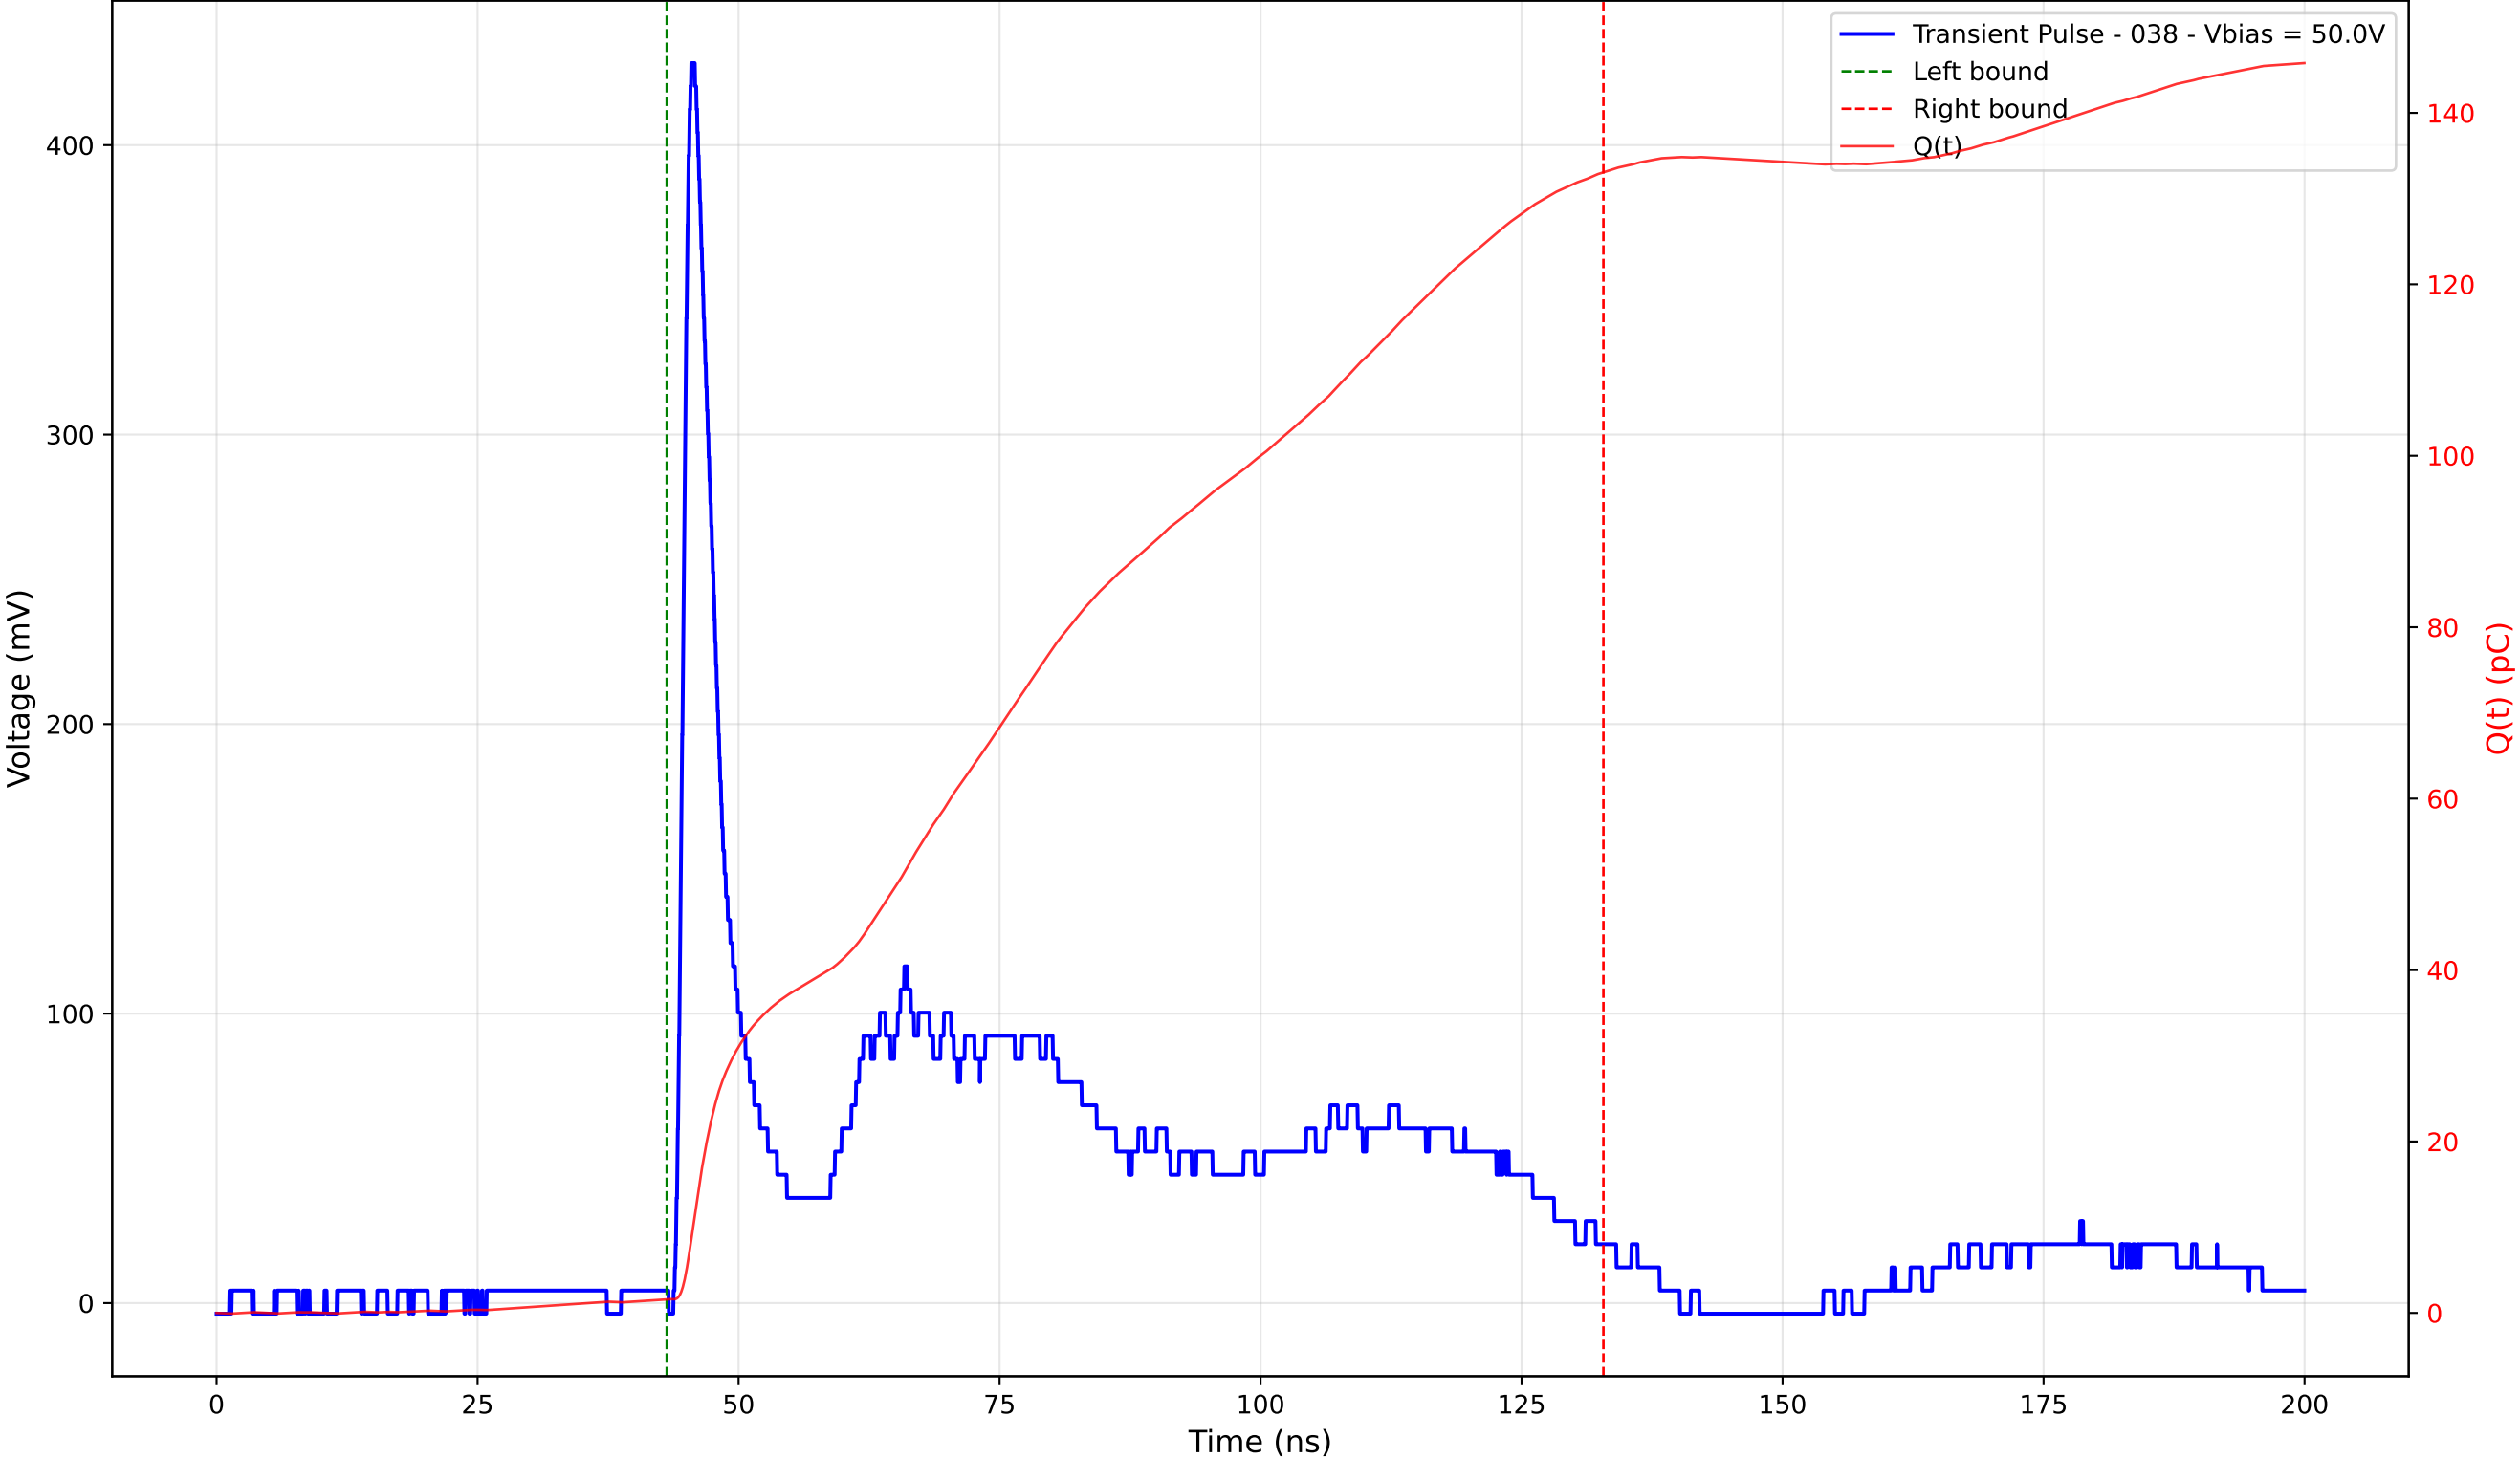


Transient Pulse - Sample: TD_4004 - Position: 185.0 μm - Charge: 133.31 pC - Rise Time: 1.08 ns

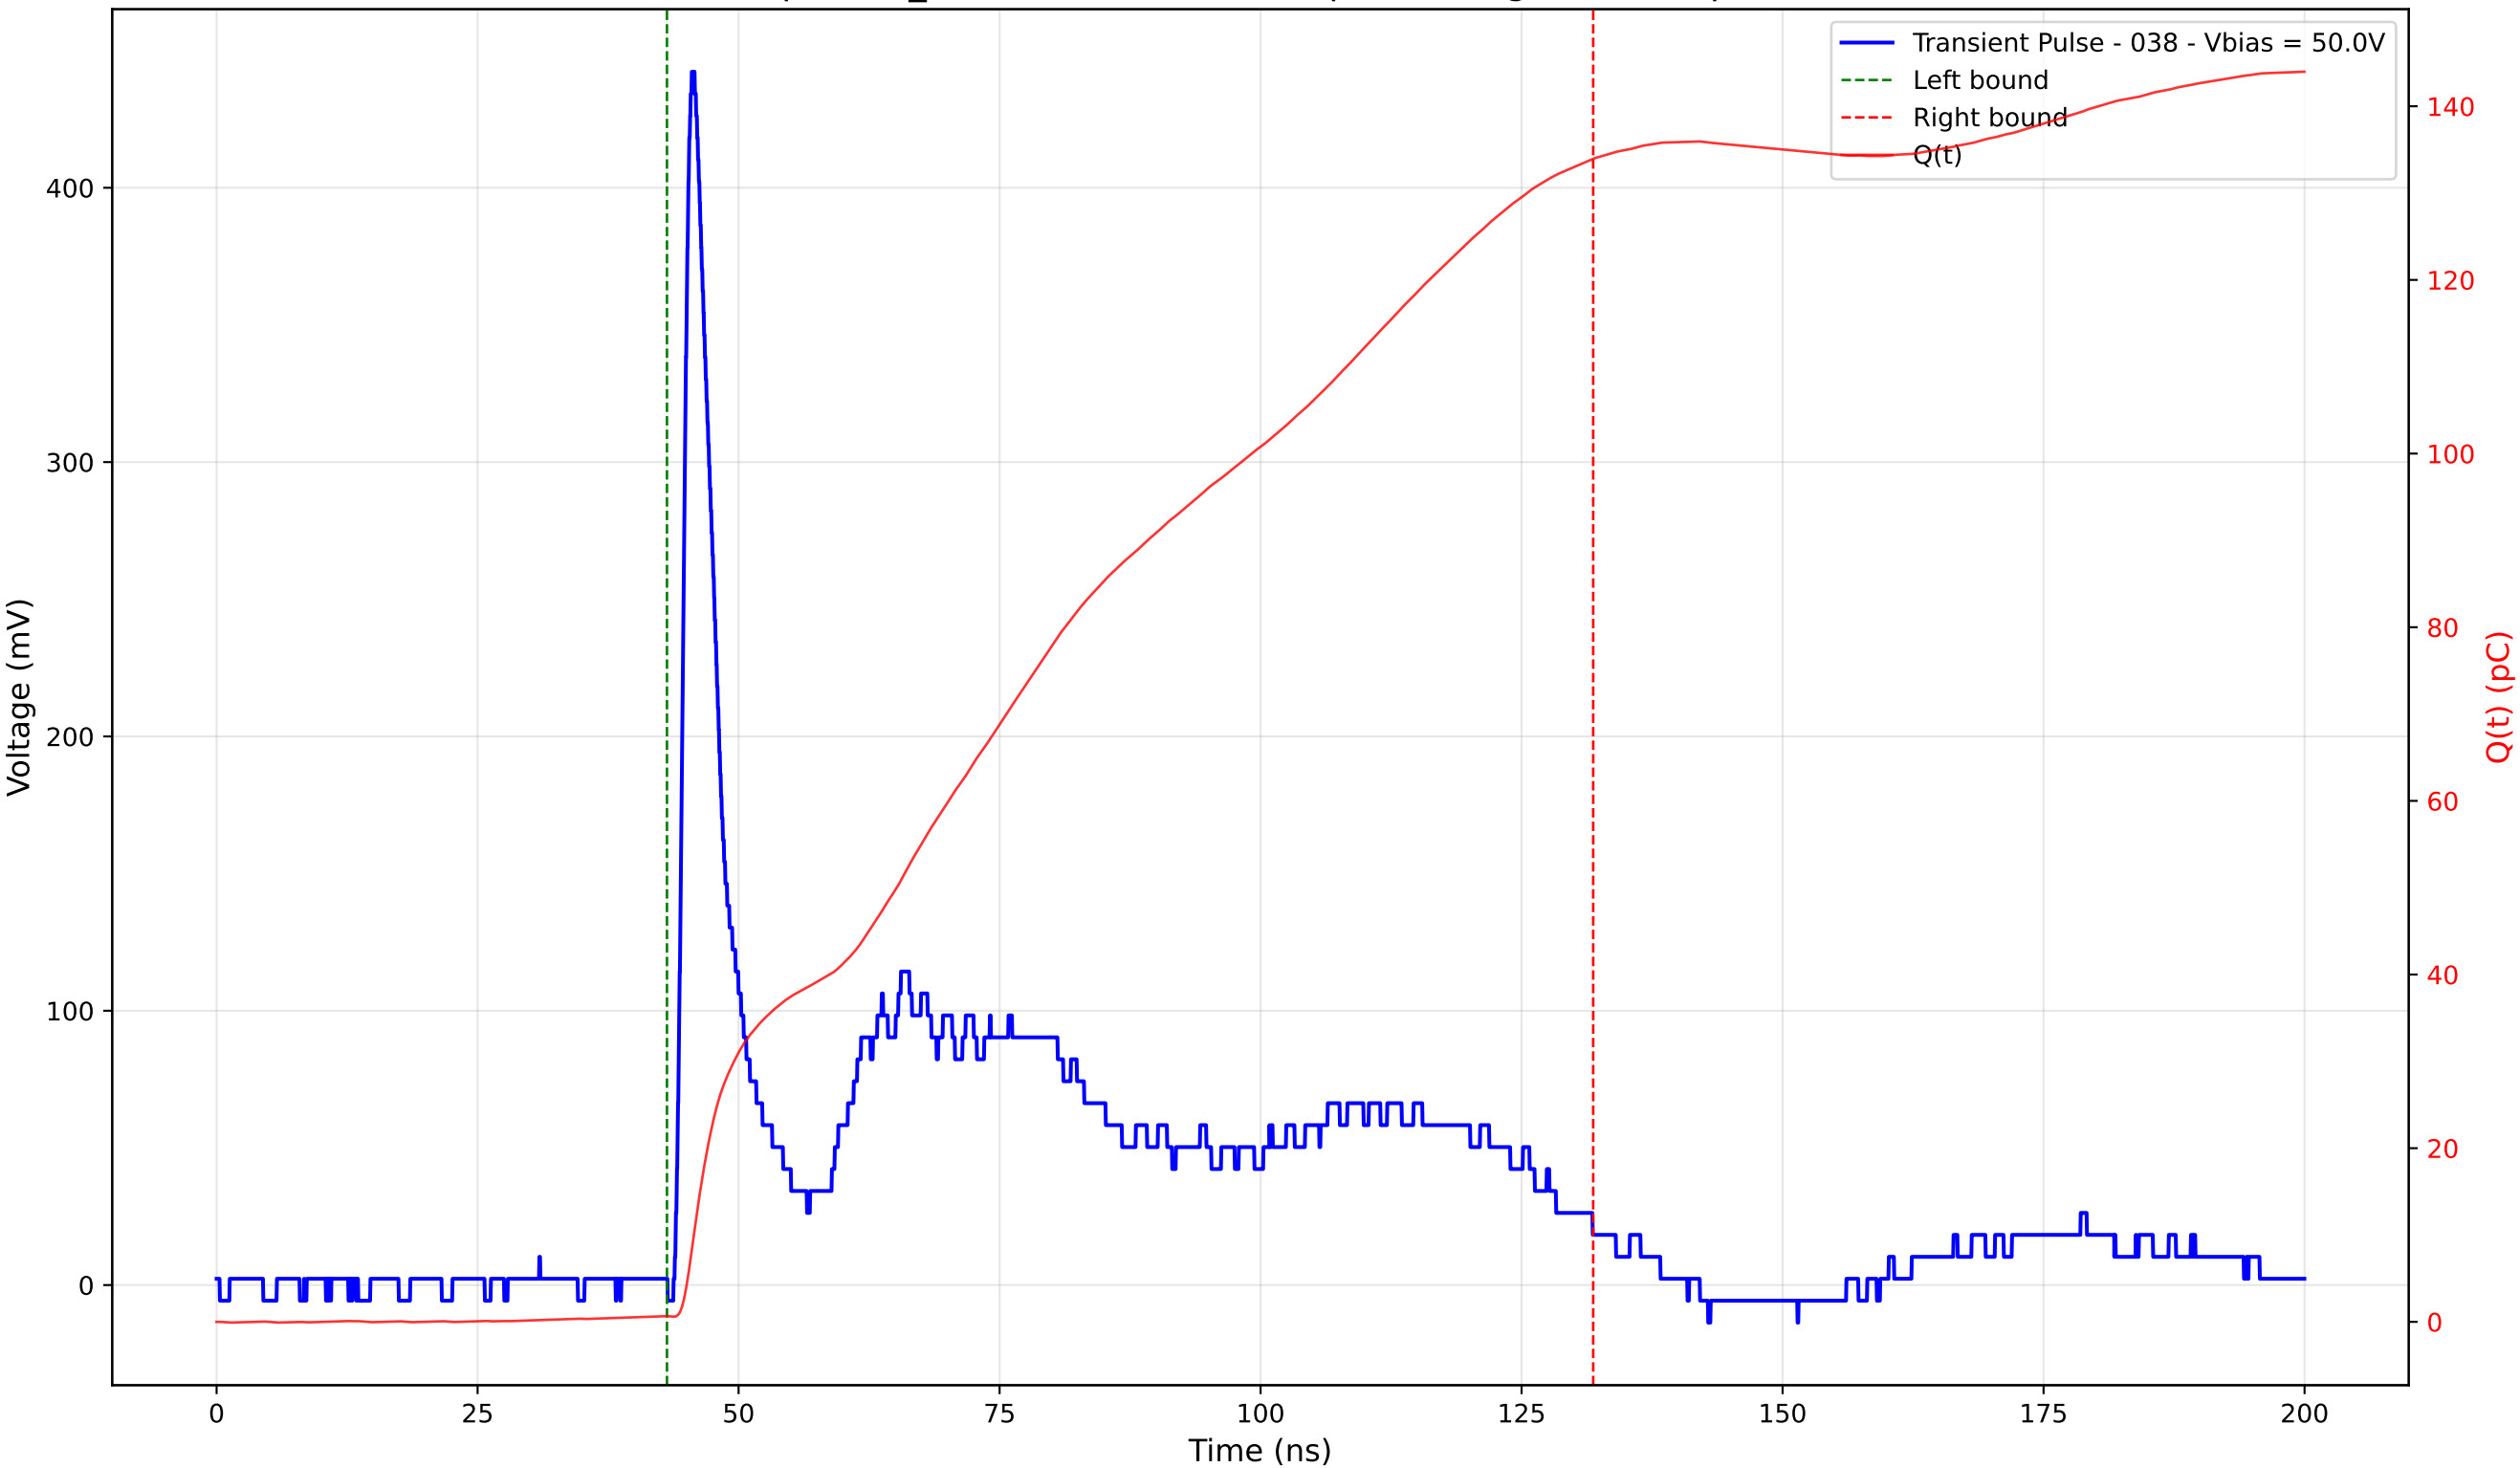


Transient Pulse - Sample: TD_4004 - Position: 190.0 μm - Charge: 136.28 pC - Rise Time: 1.07 ns

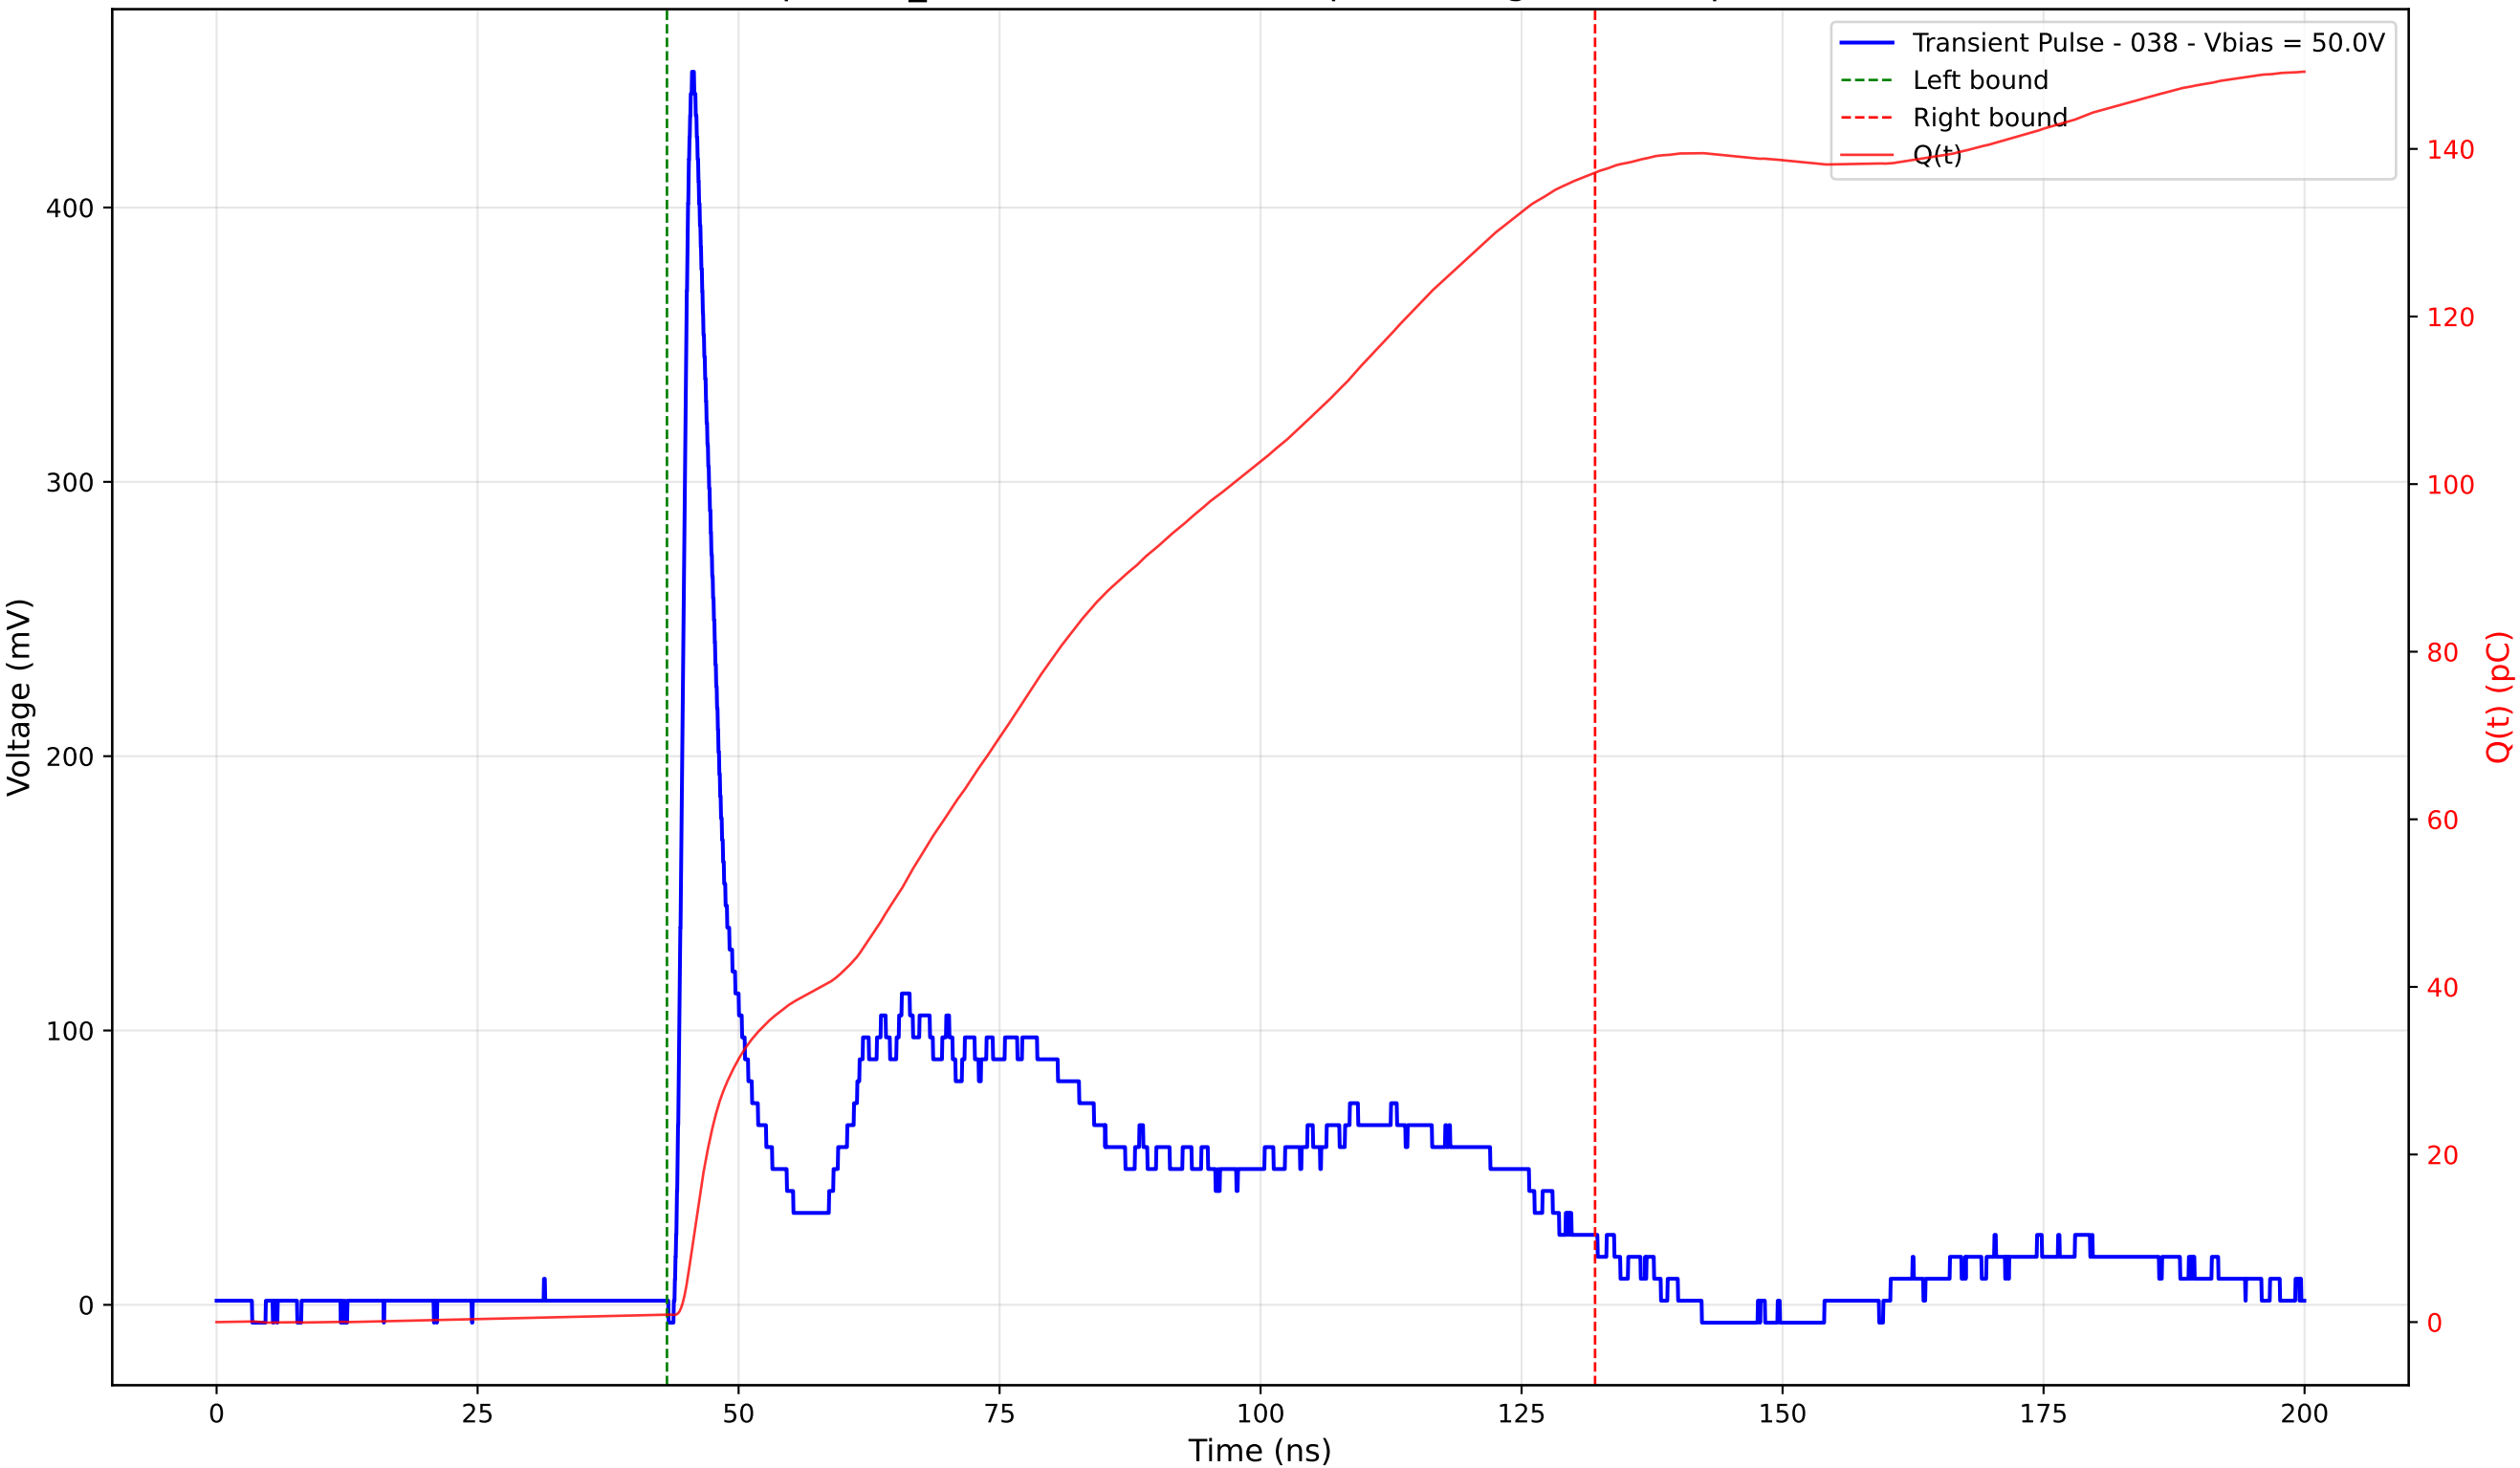


Transient Pulse - Sample: TD_4004 - Position: 195.0 μm - Charge: 140.53 pC - Rise Time: 1.08 ns

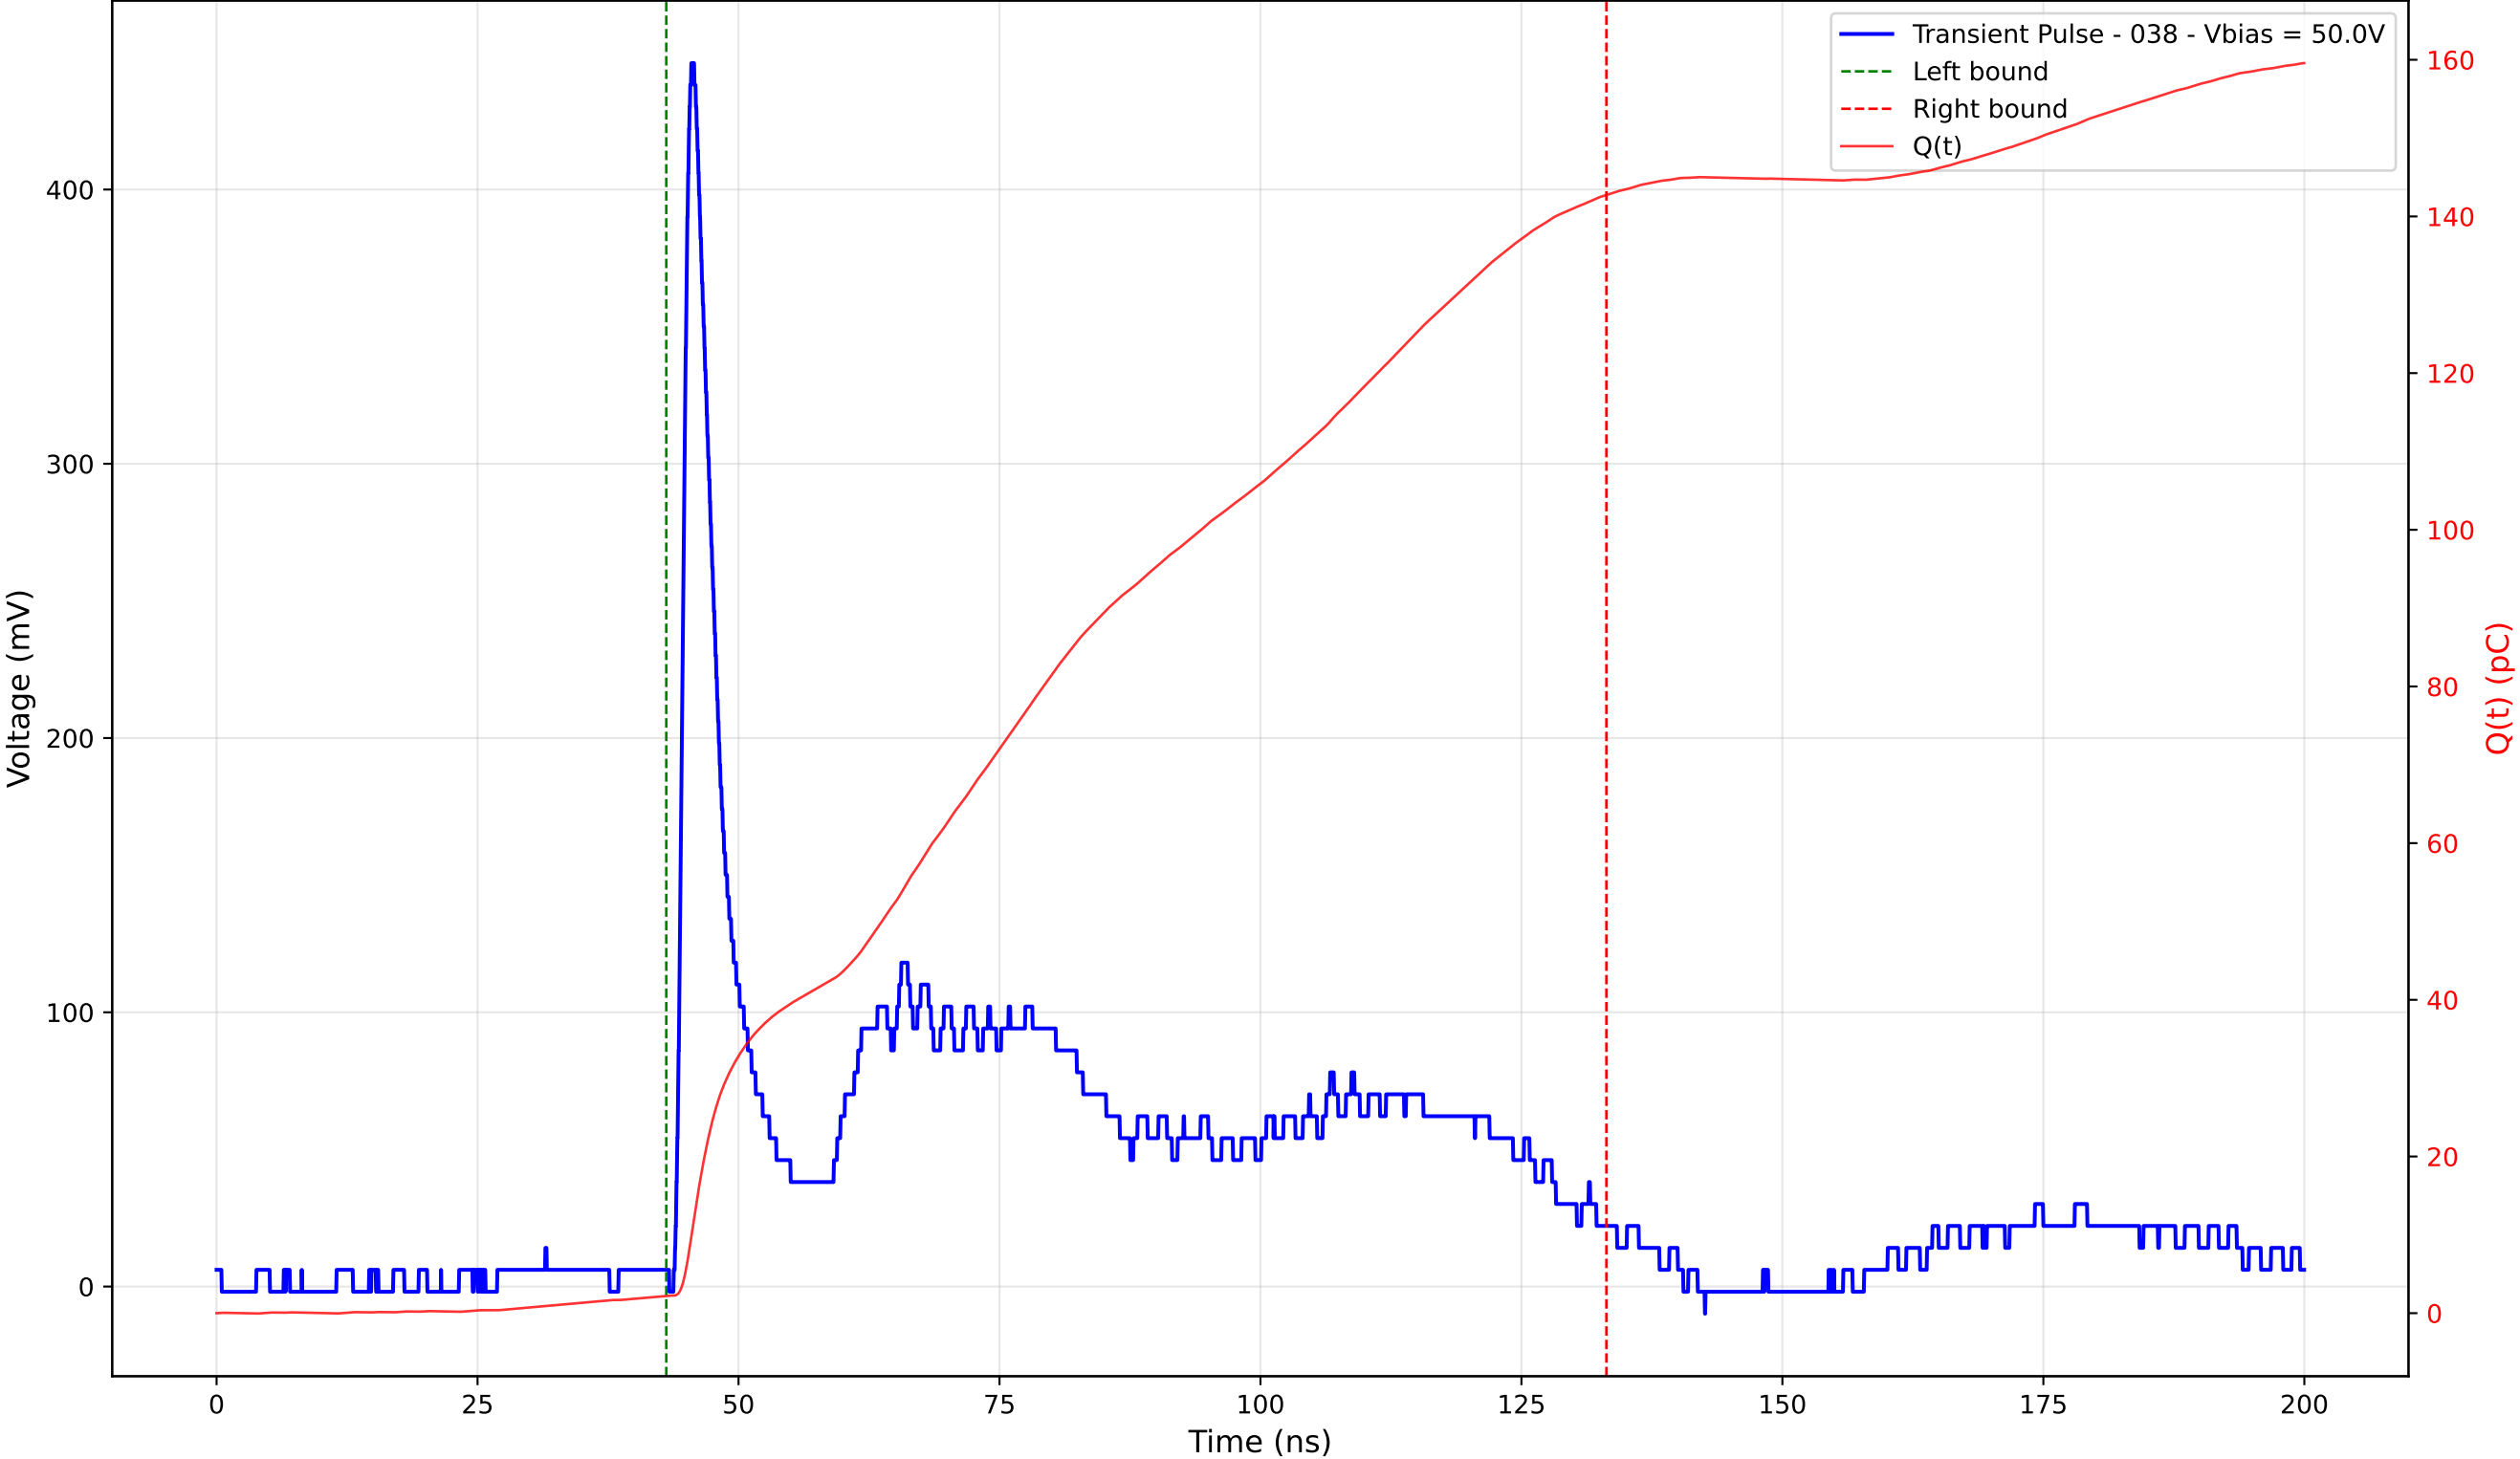


Transient Pulse - Sample: TD_4004 - Position: 200.0 μm - Charge: 120.63 pC - Rise Time: 1.05 ns

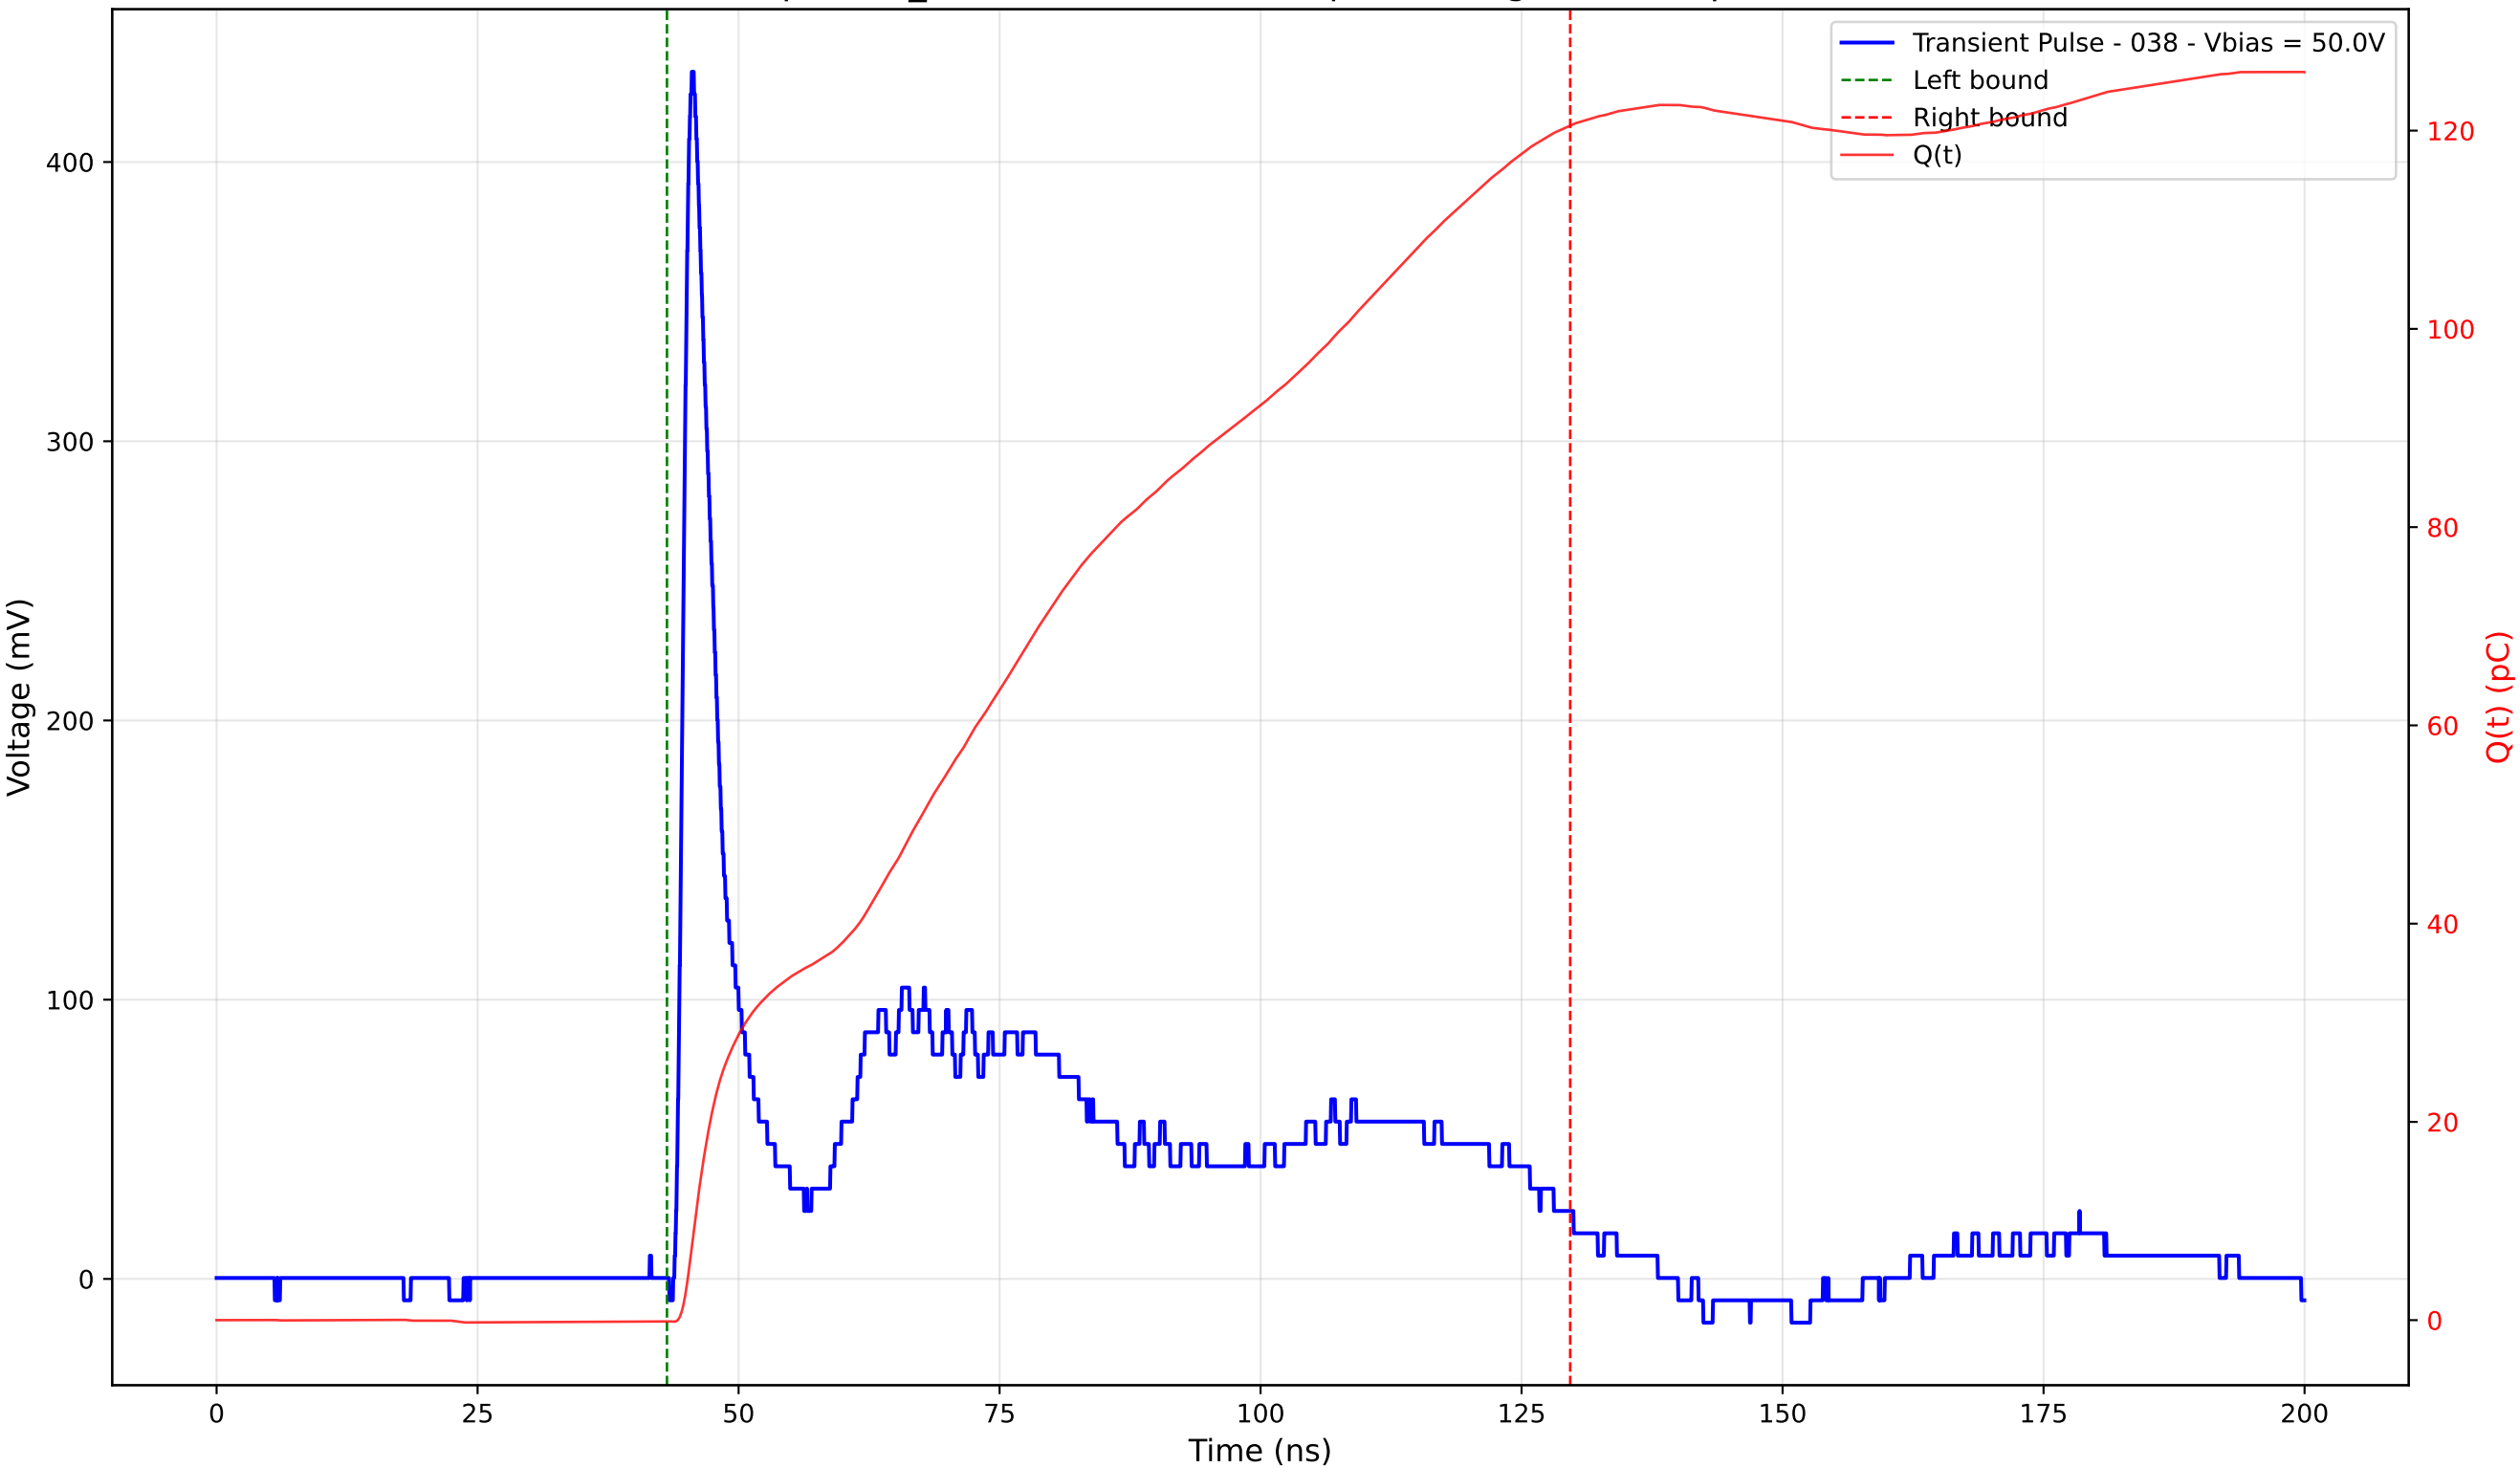


Transient Pulse - Sample: TD_4004 - Position: 205.0 μm - Charge: 124.99 pC - Rise Time: 1.06 ns

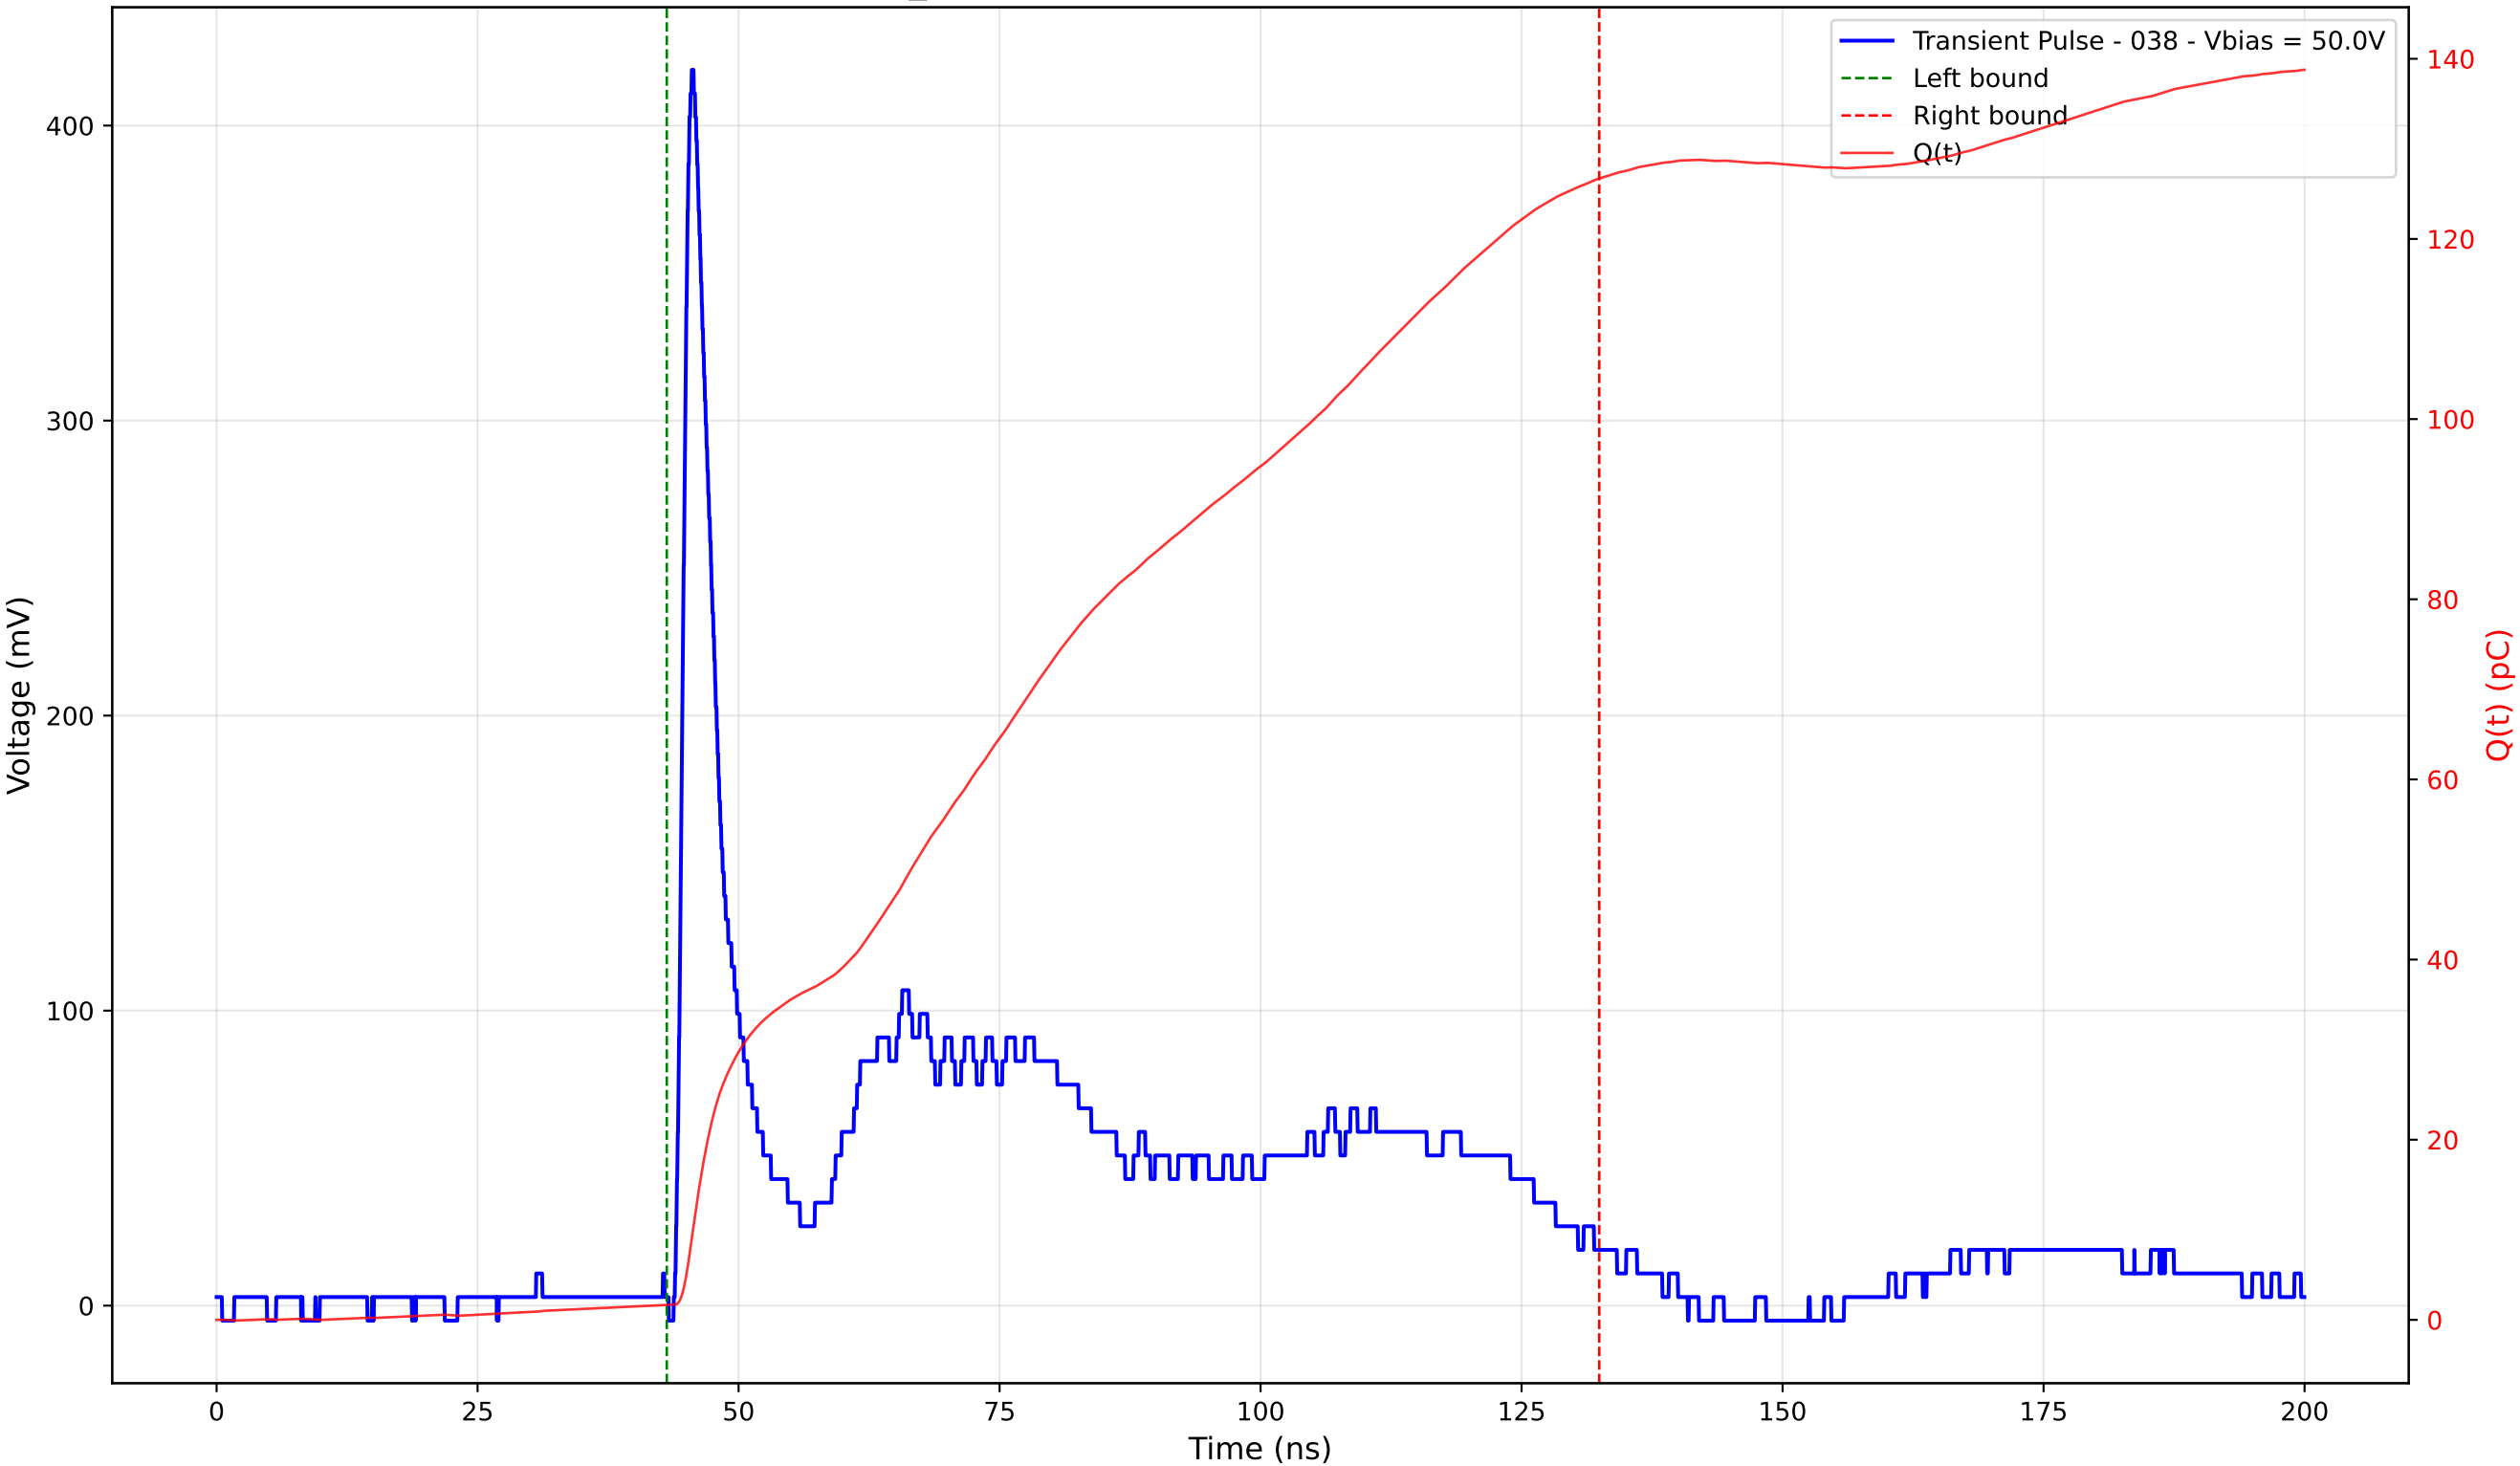


Transient Pulse - Sample: TD_4004 - Position: 210.0 μm - Charge: 115.56 pC - Rise Time: 1.08 ns

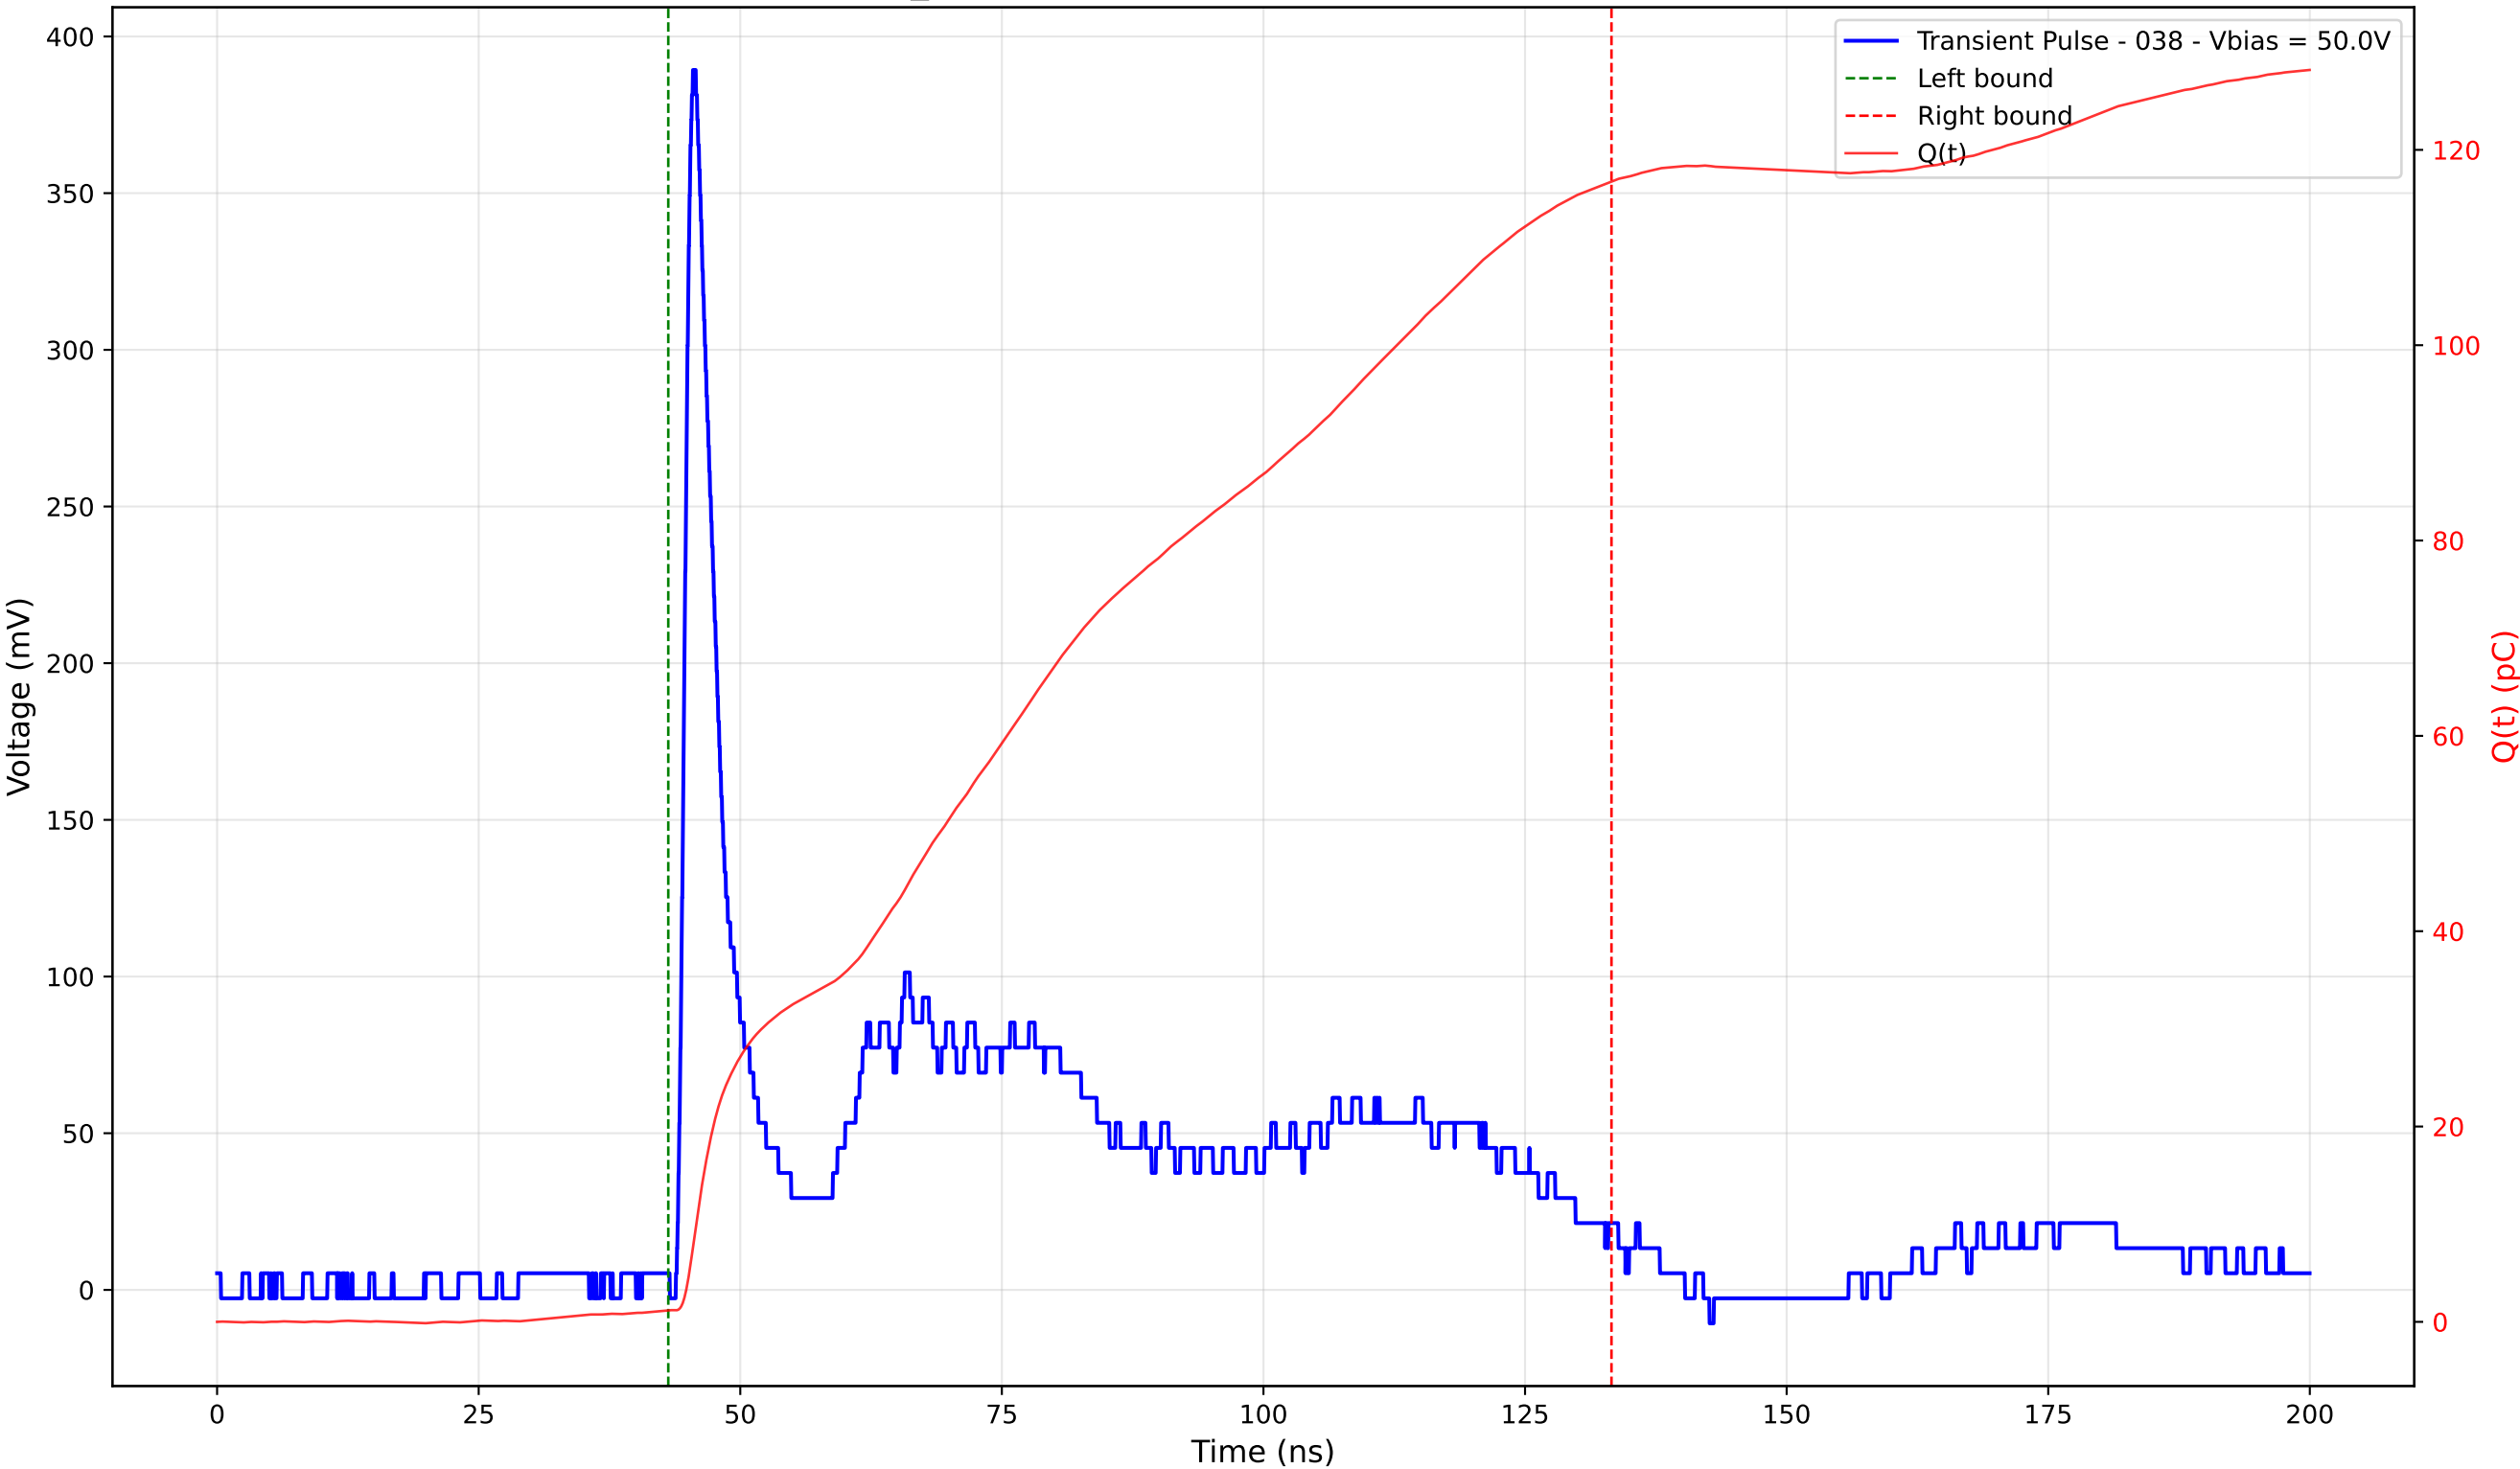


Transient Pulse - Sample: TD_4004 - Position: 215.0 μm - Charge: 106.33 pC - Rise Time: 1.07 ns

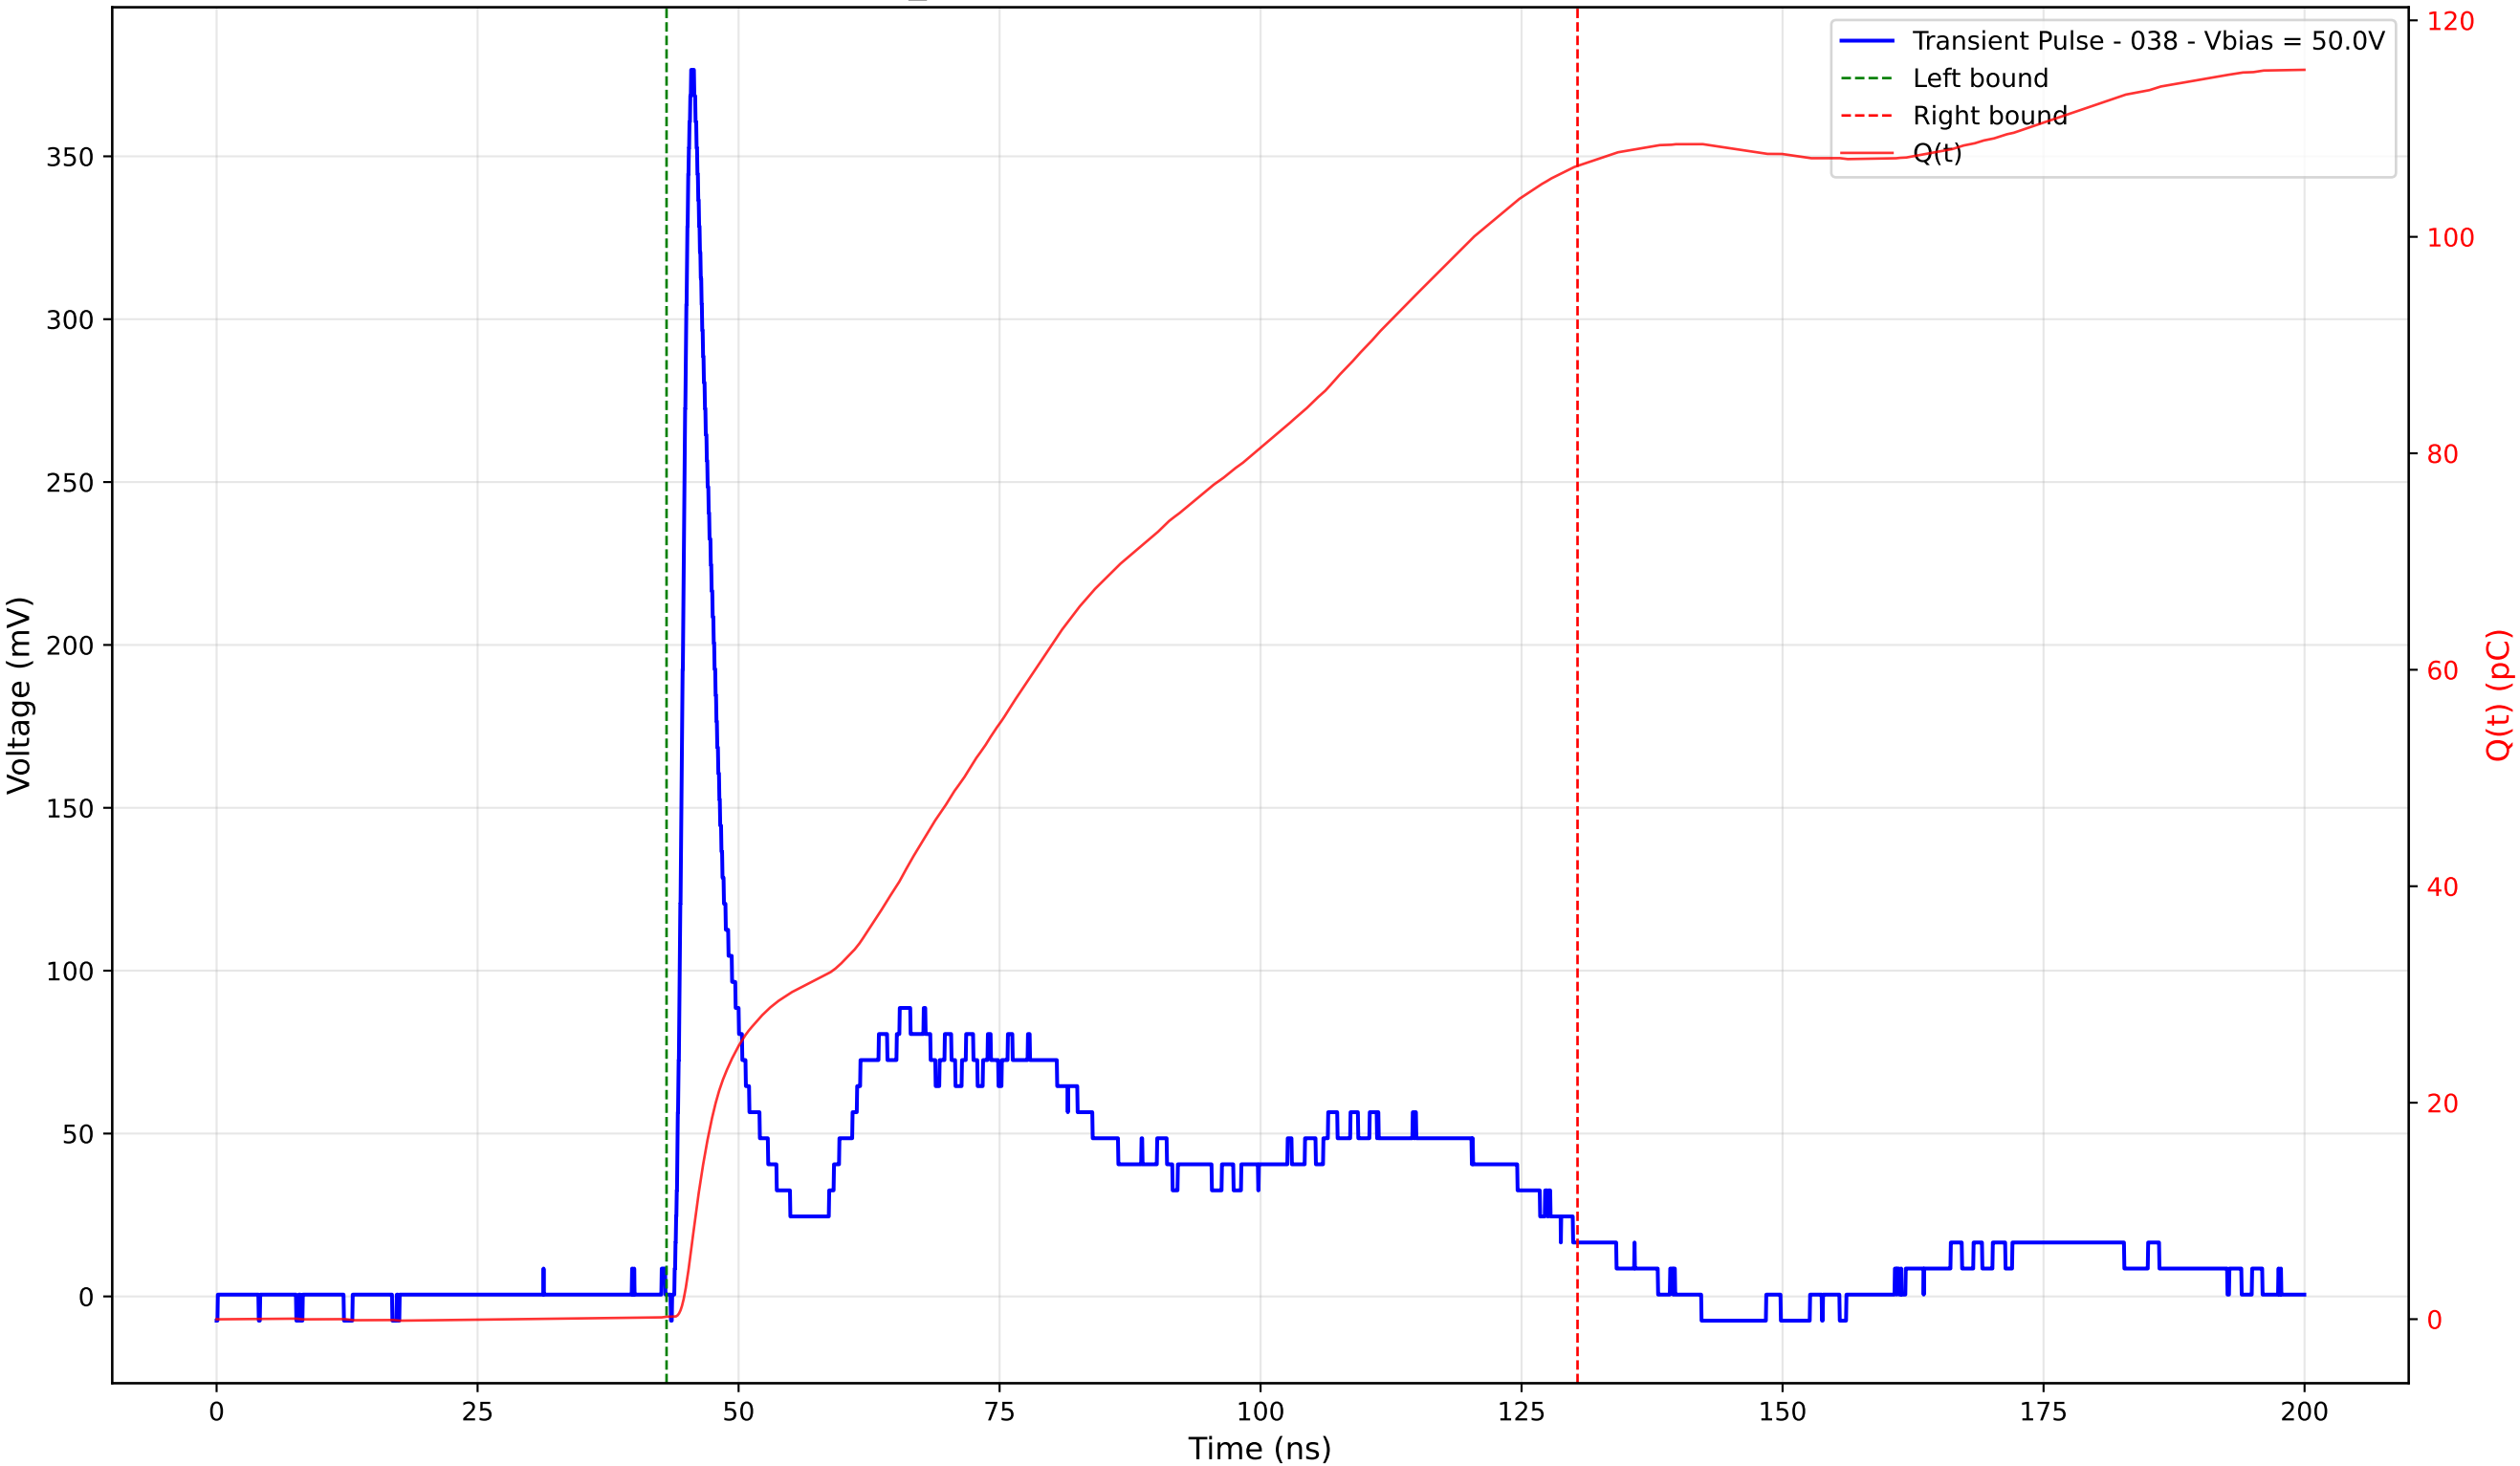


Transient Pulse - Sample: TD_4004 - Position: 220.0 μm - Charge: 109.40 pC - Rise Time: 1.02 ns

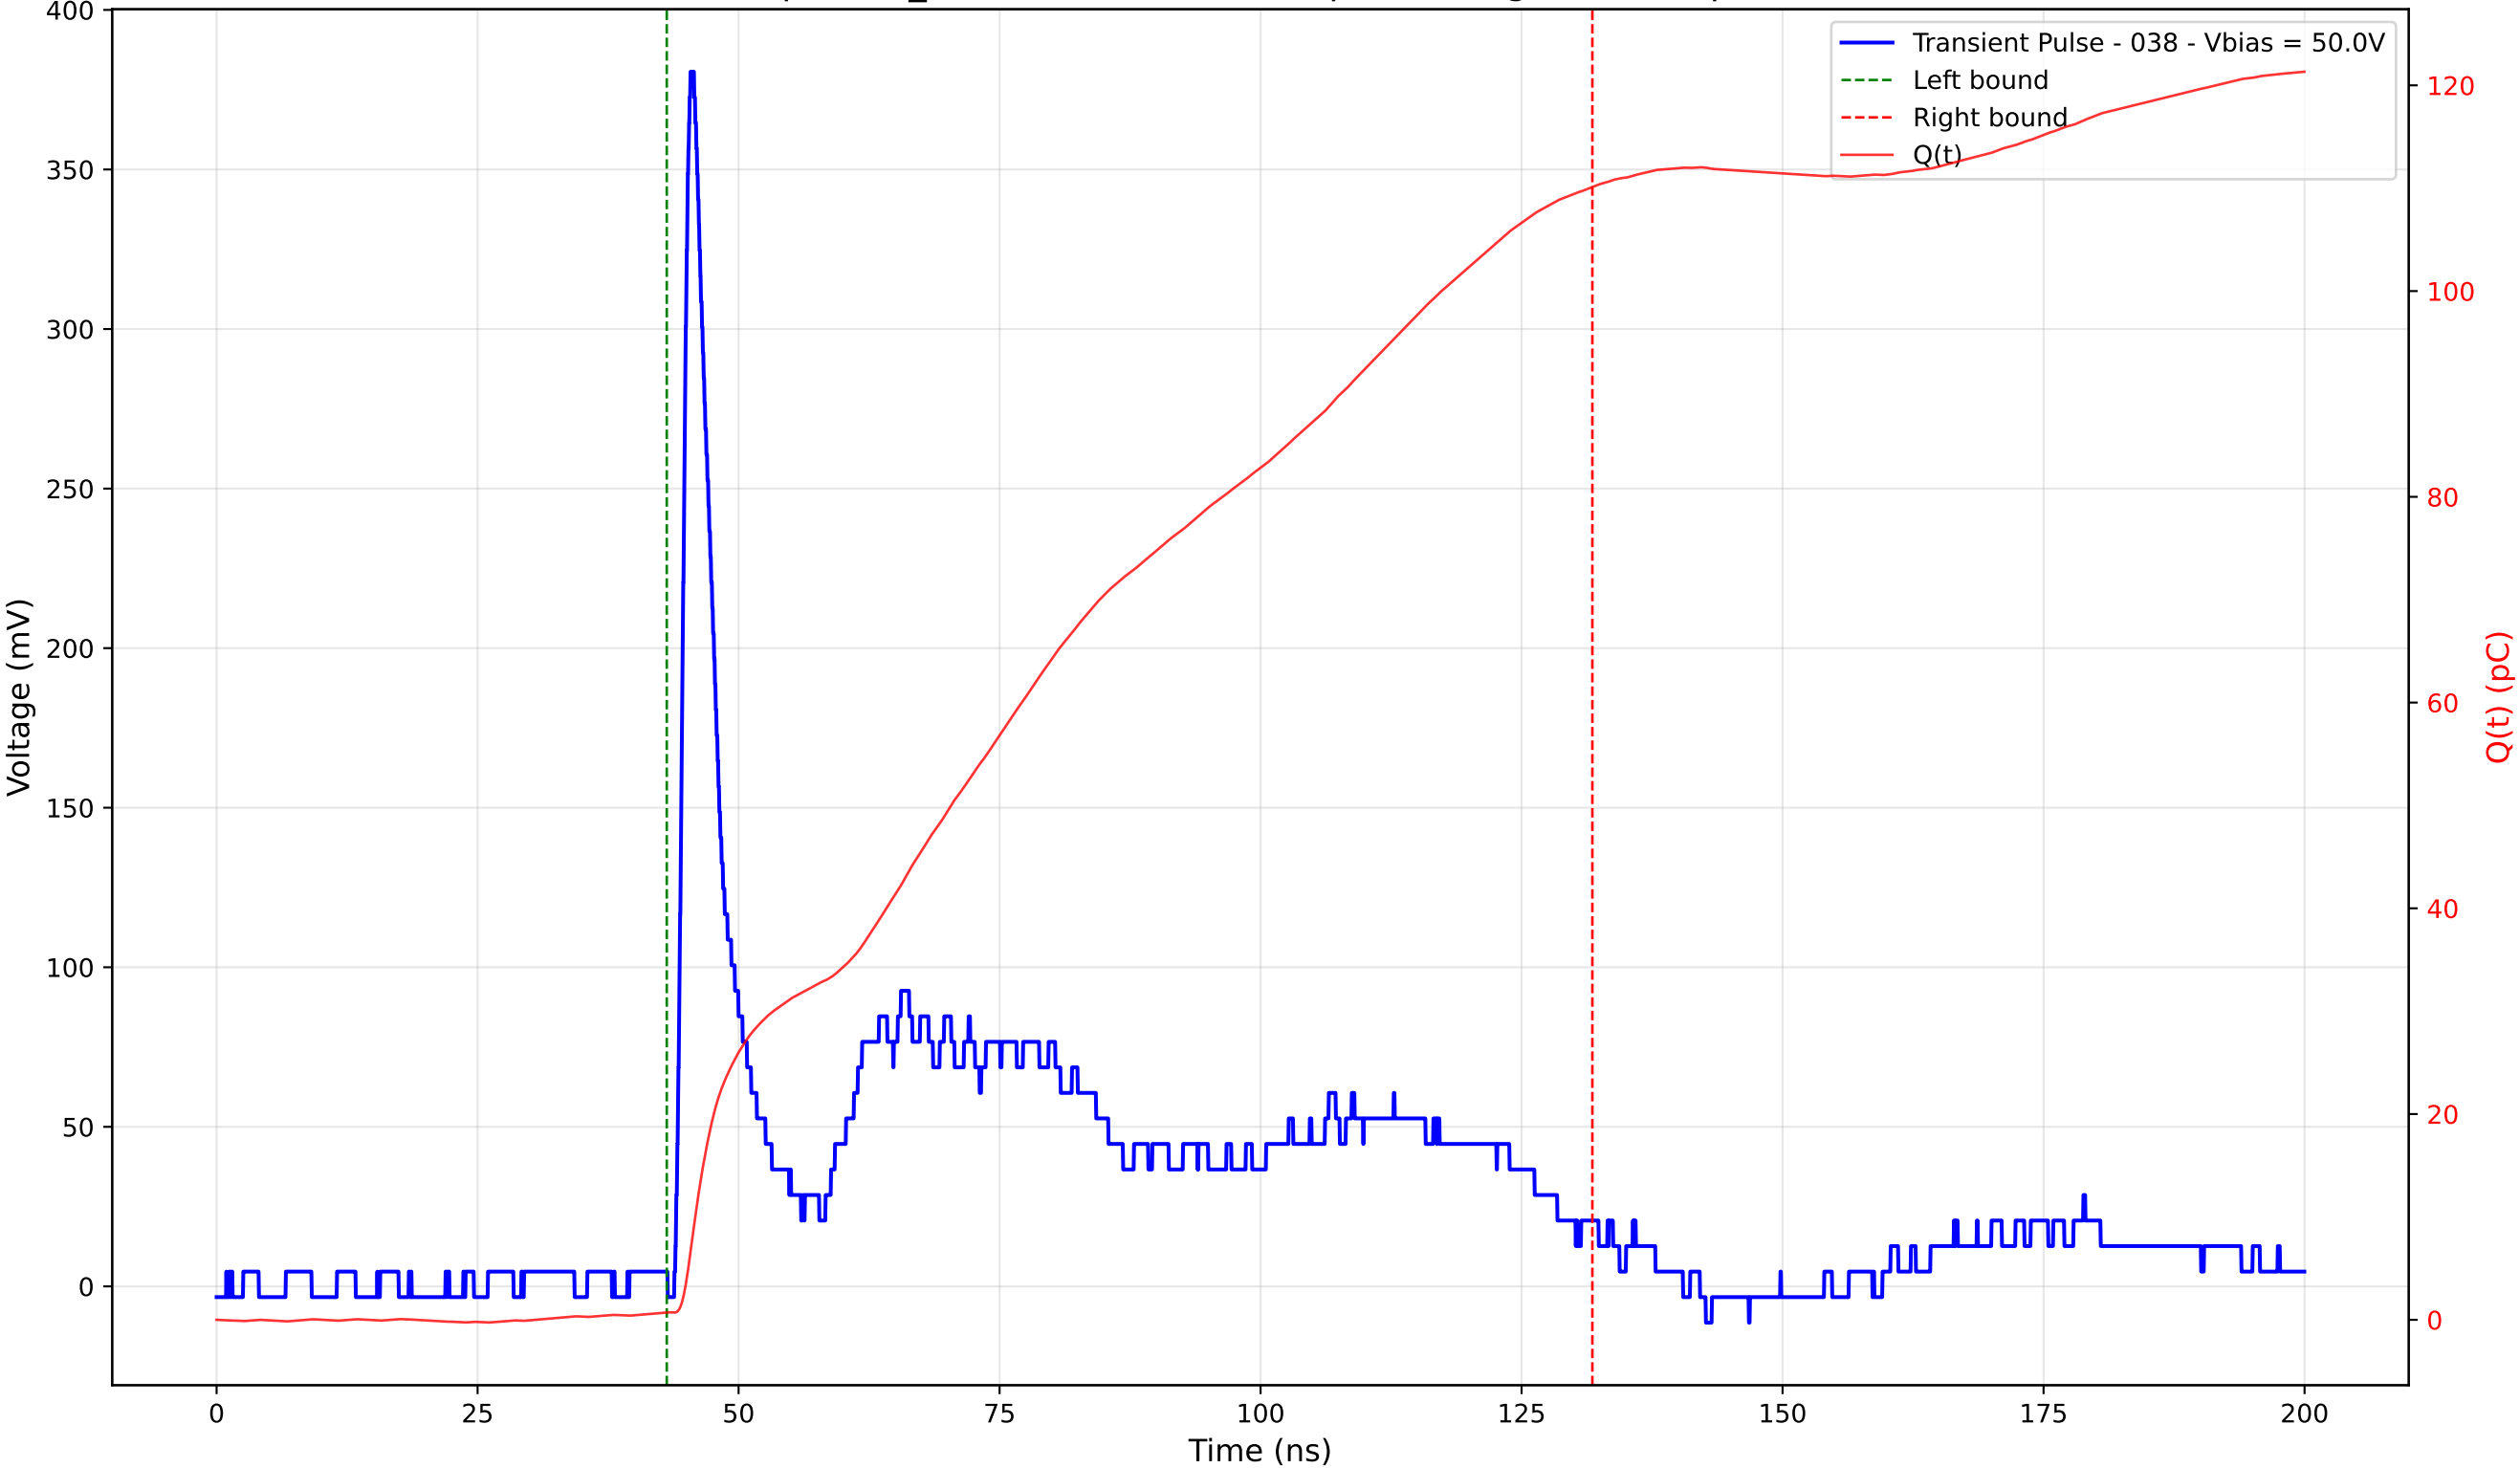


Transient Pulse - Sample: TD_4004 - Position: 225.0 μm - Charge: 99.51 pC - Rise Time: 1.05 ns

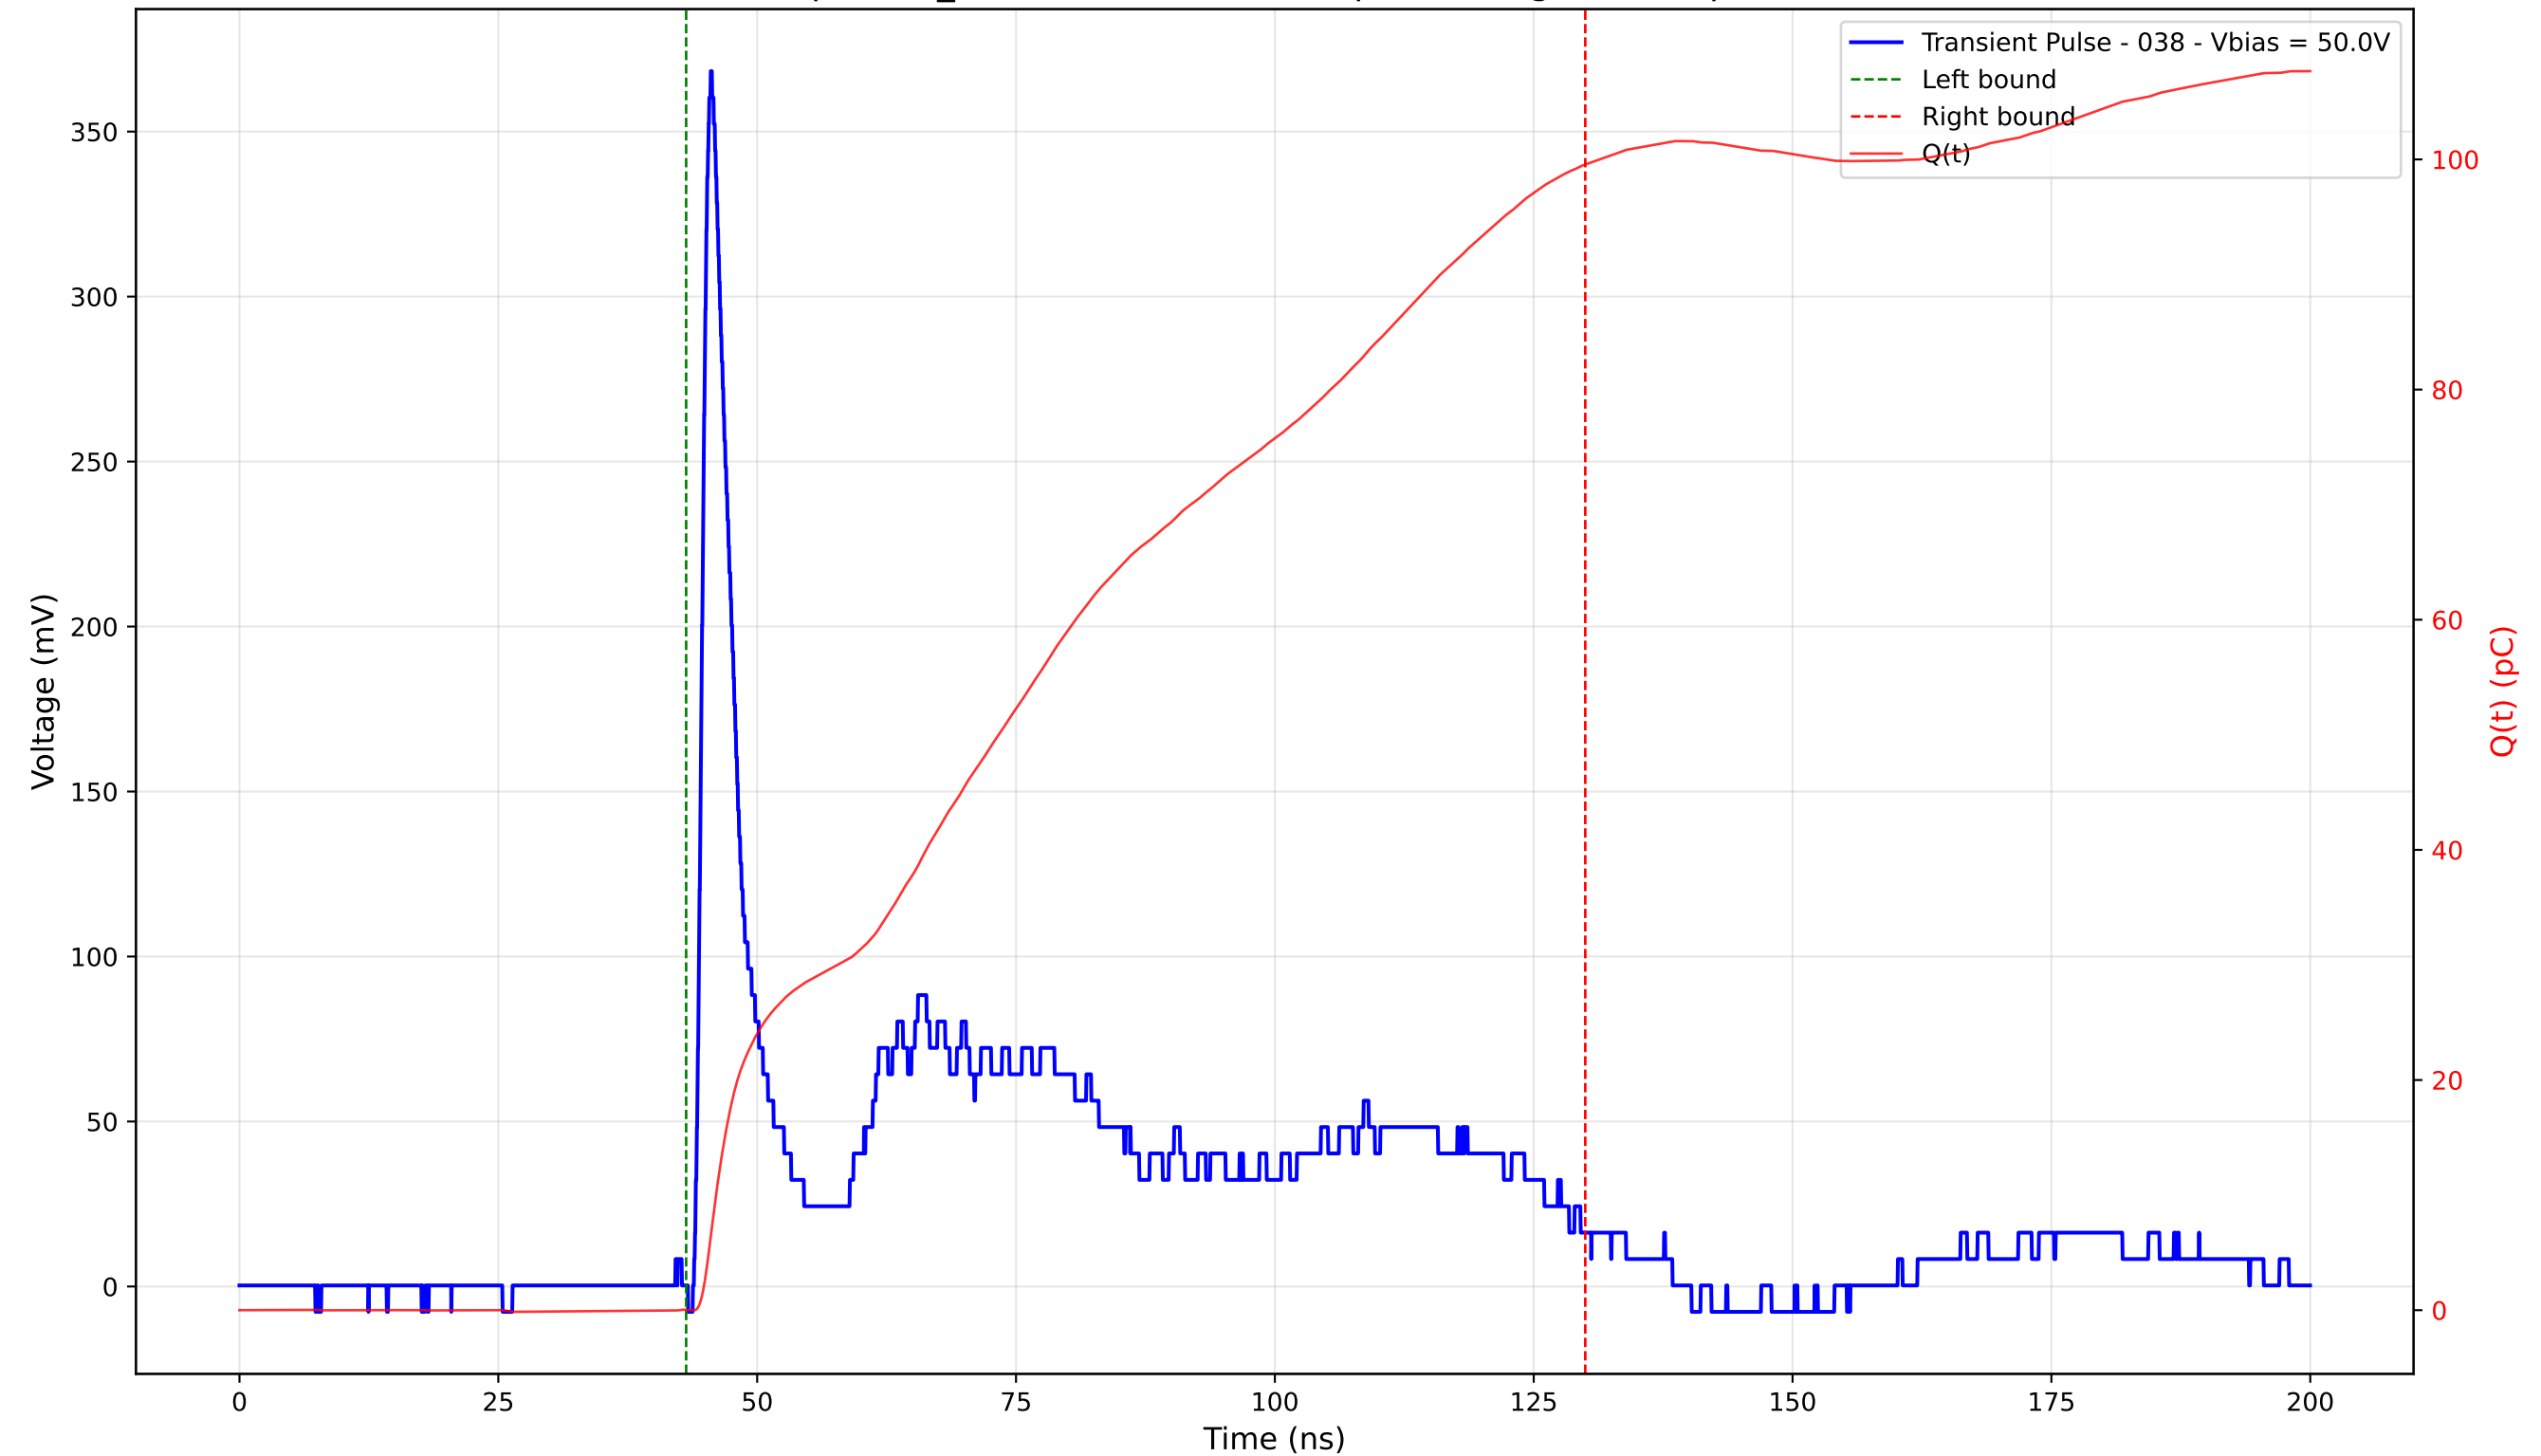


Transient Pulse - Sample: TD_4004 - Position: 230.0 μm - Charge: 94.60 pC - Rise Time: 1.05 ns

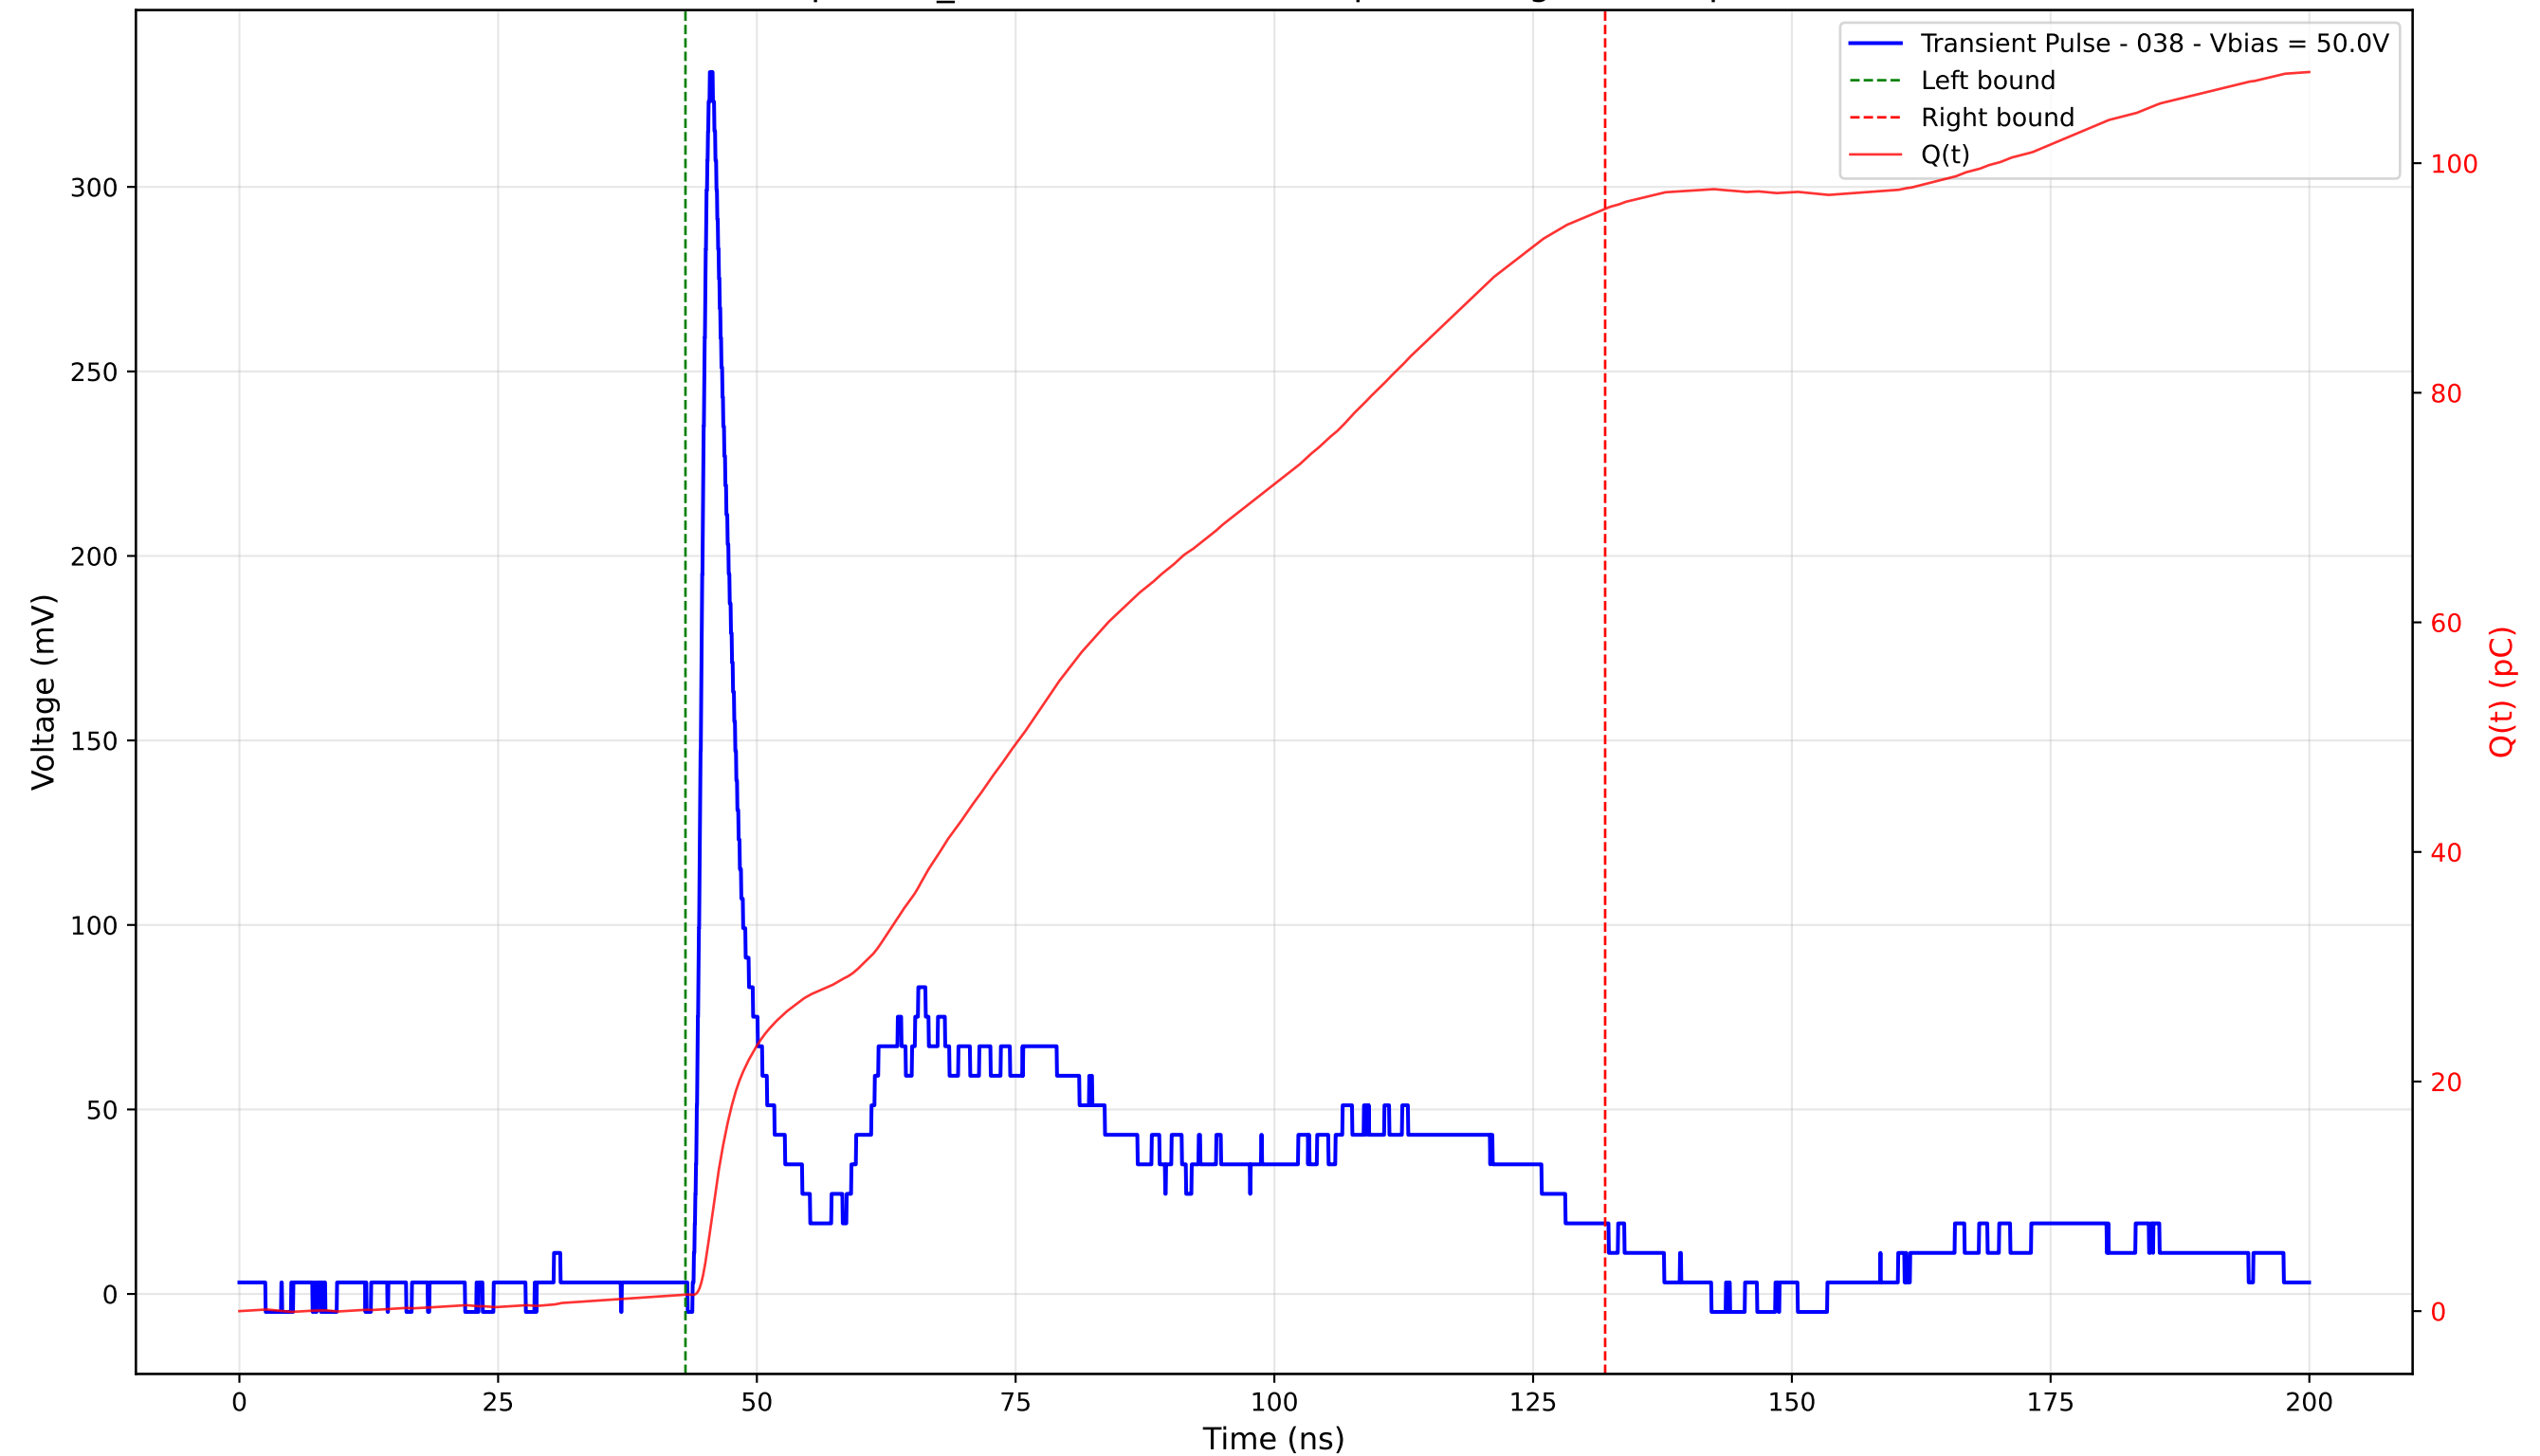


Transient Pulse - Sample: TD_4004 - Position: 235.0 μm - Charge: 75.81 pC - Rise Time: 1.05 ns

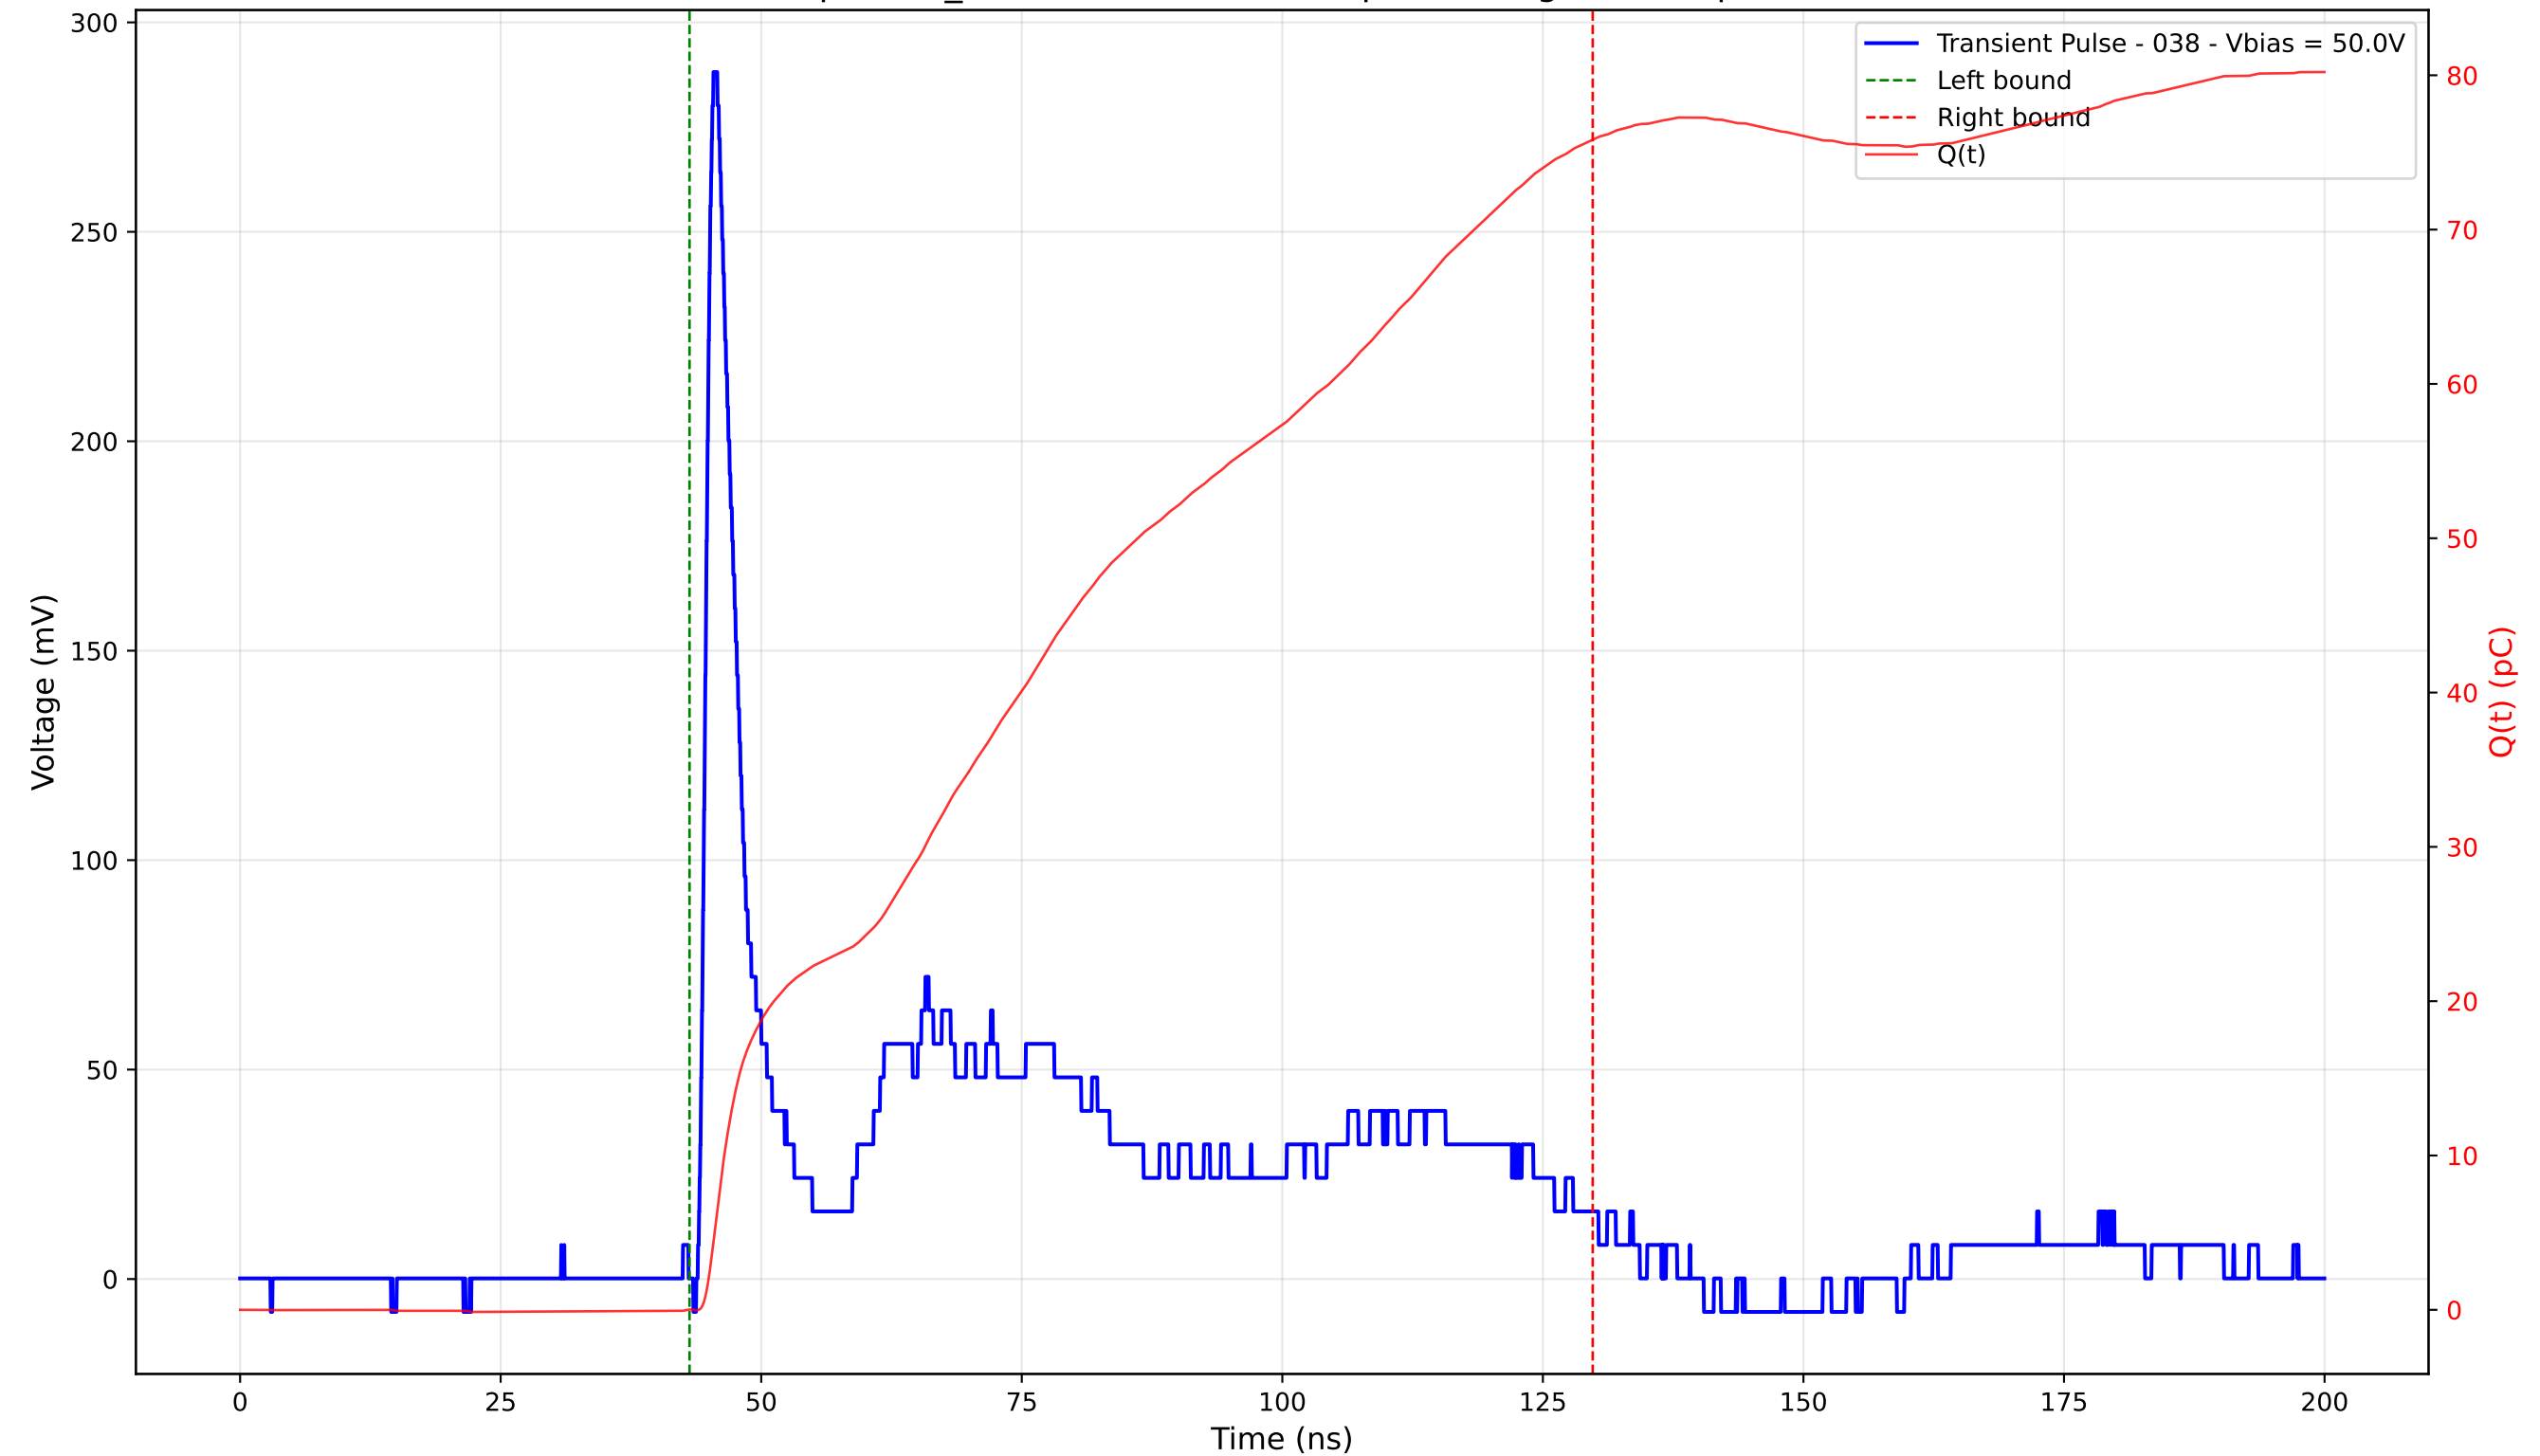


Transient Pulse - Sample: TD_4004 - Position: 240.0 μm - Charge: 72.68 pC - Rise Time: 1.05 ns

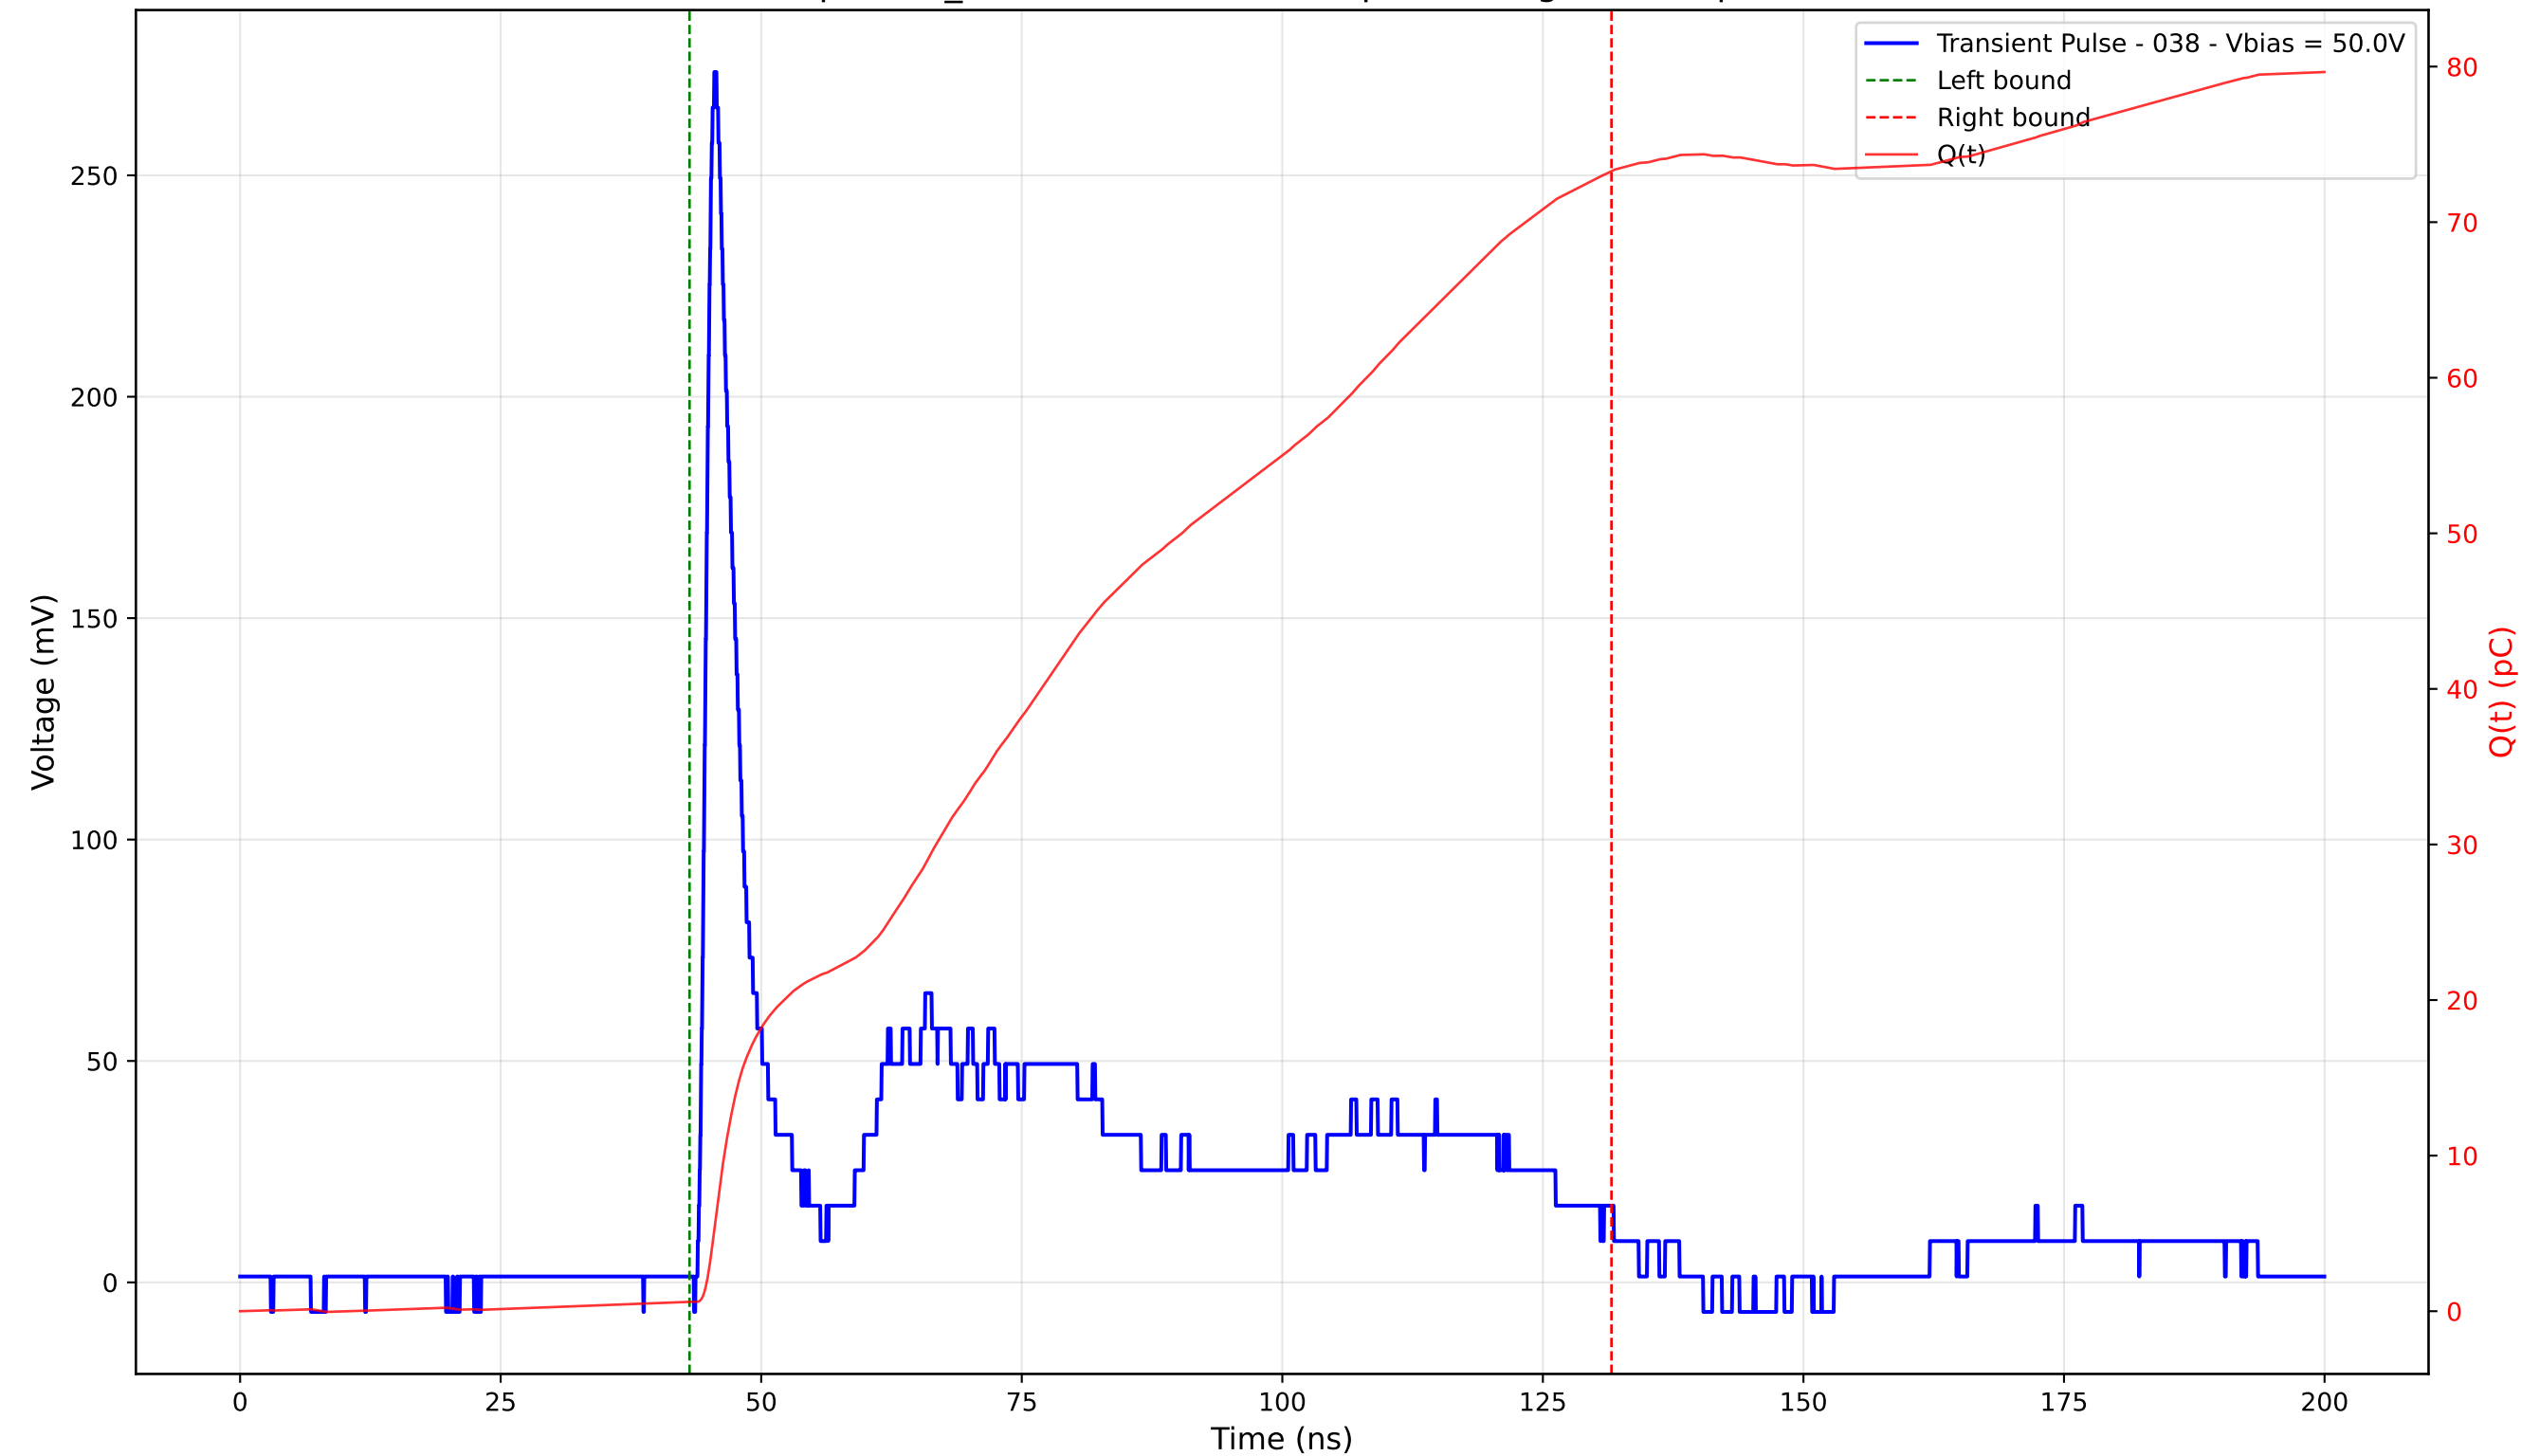


Transient Pulse - Sample: TD_4004 - Position: 245.0 μm - Charge: 74.99 pC - Rise Time: 1.06 ns

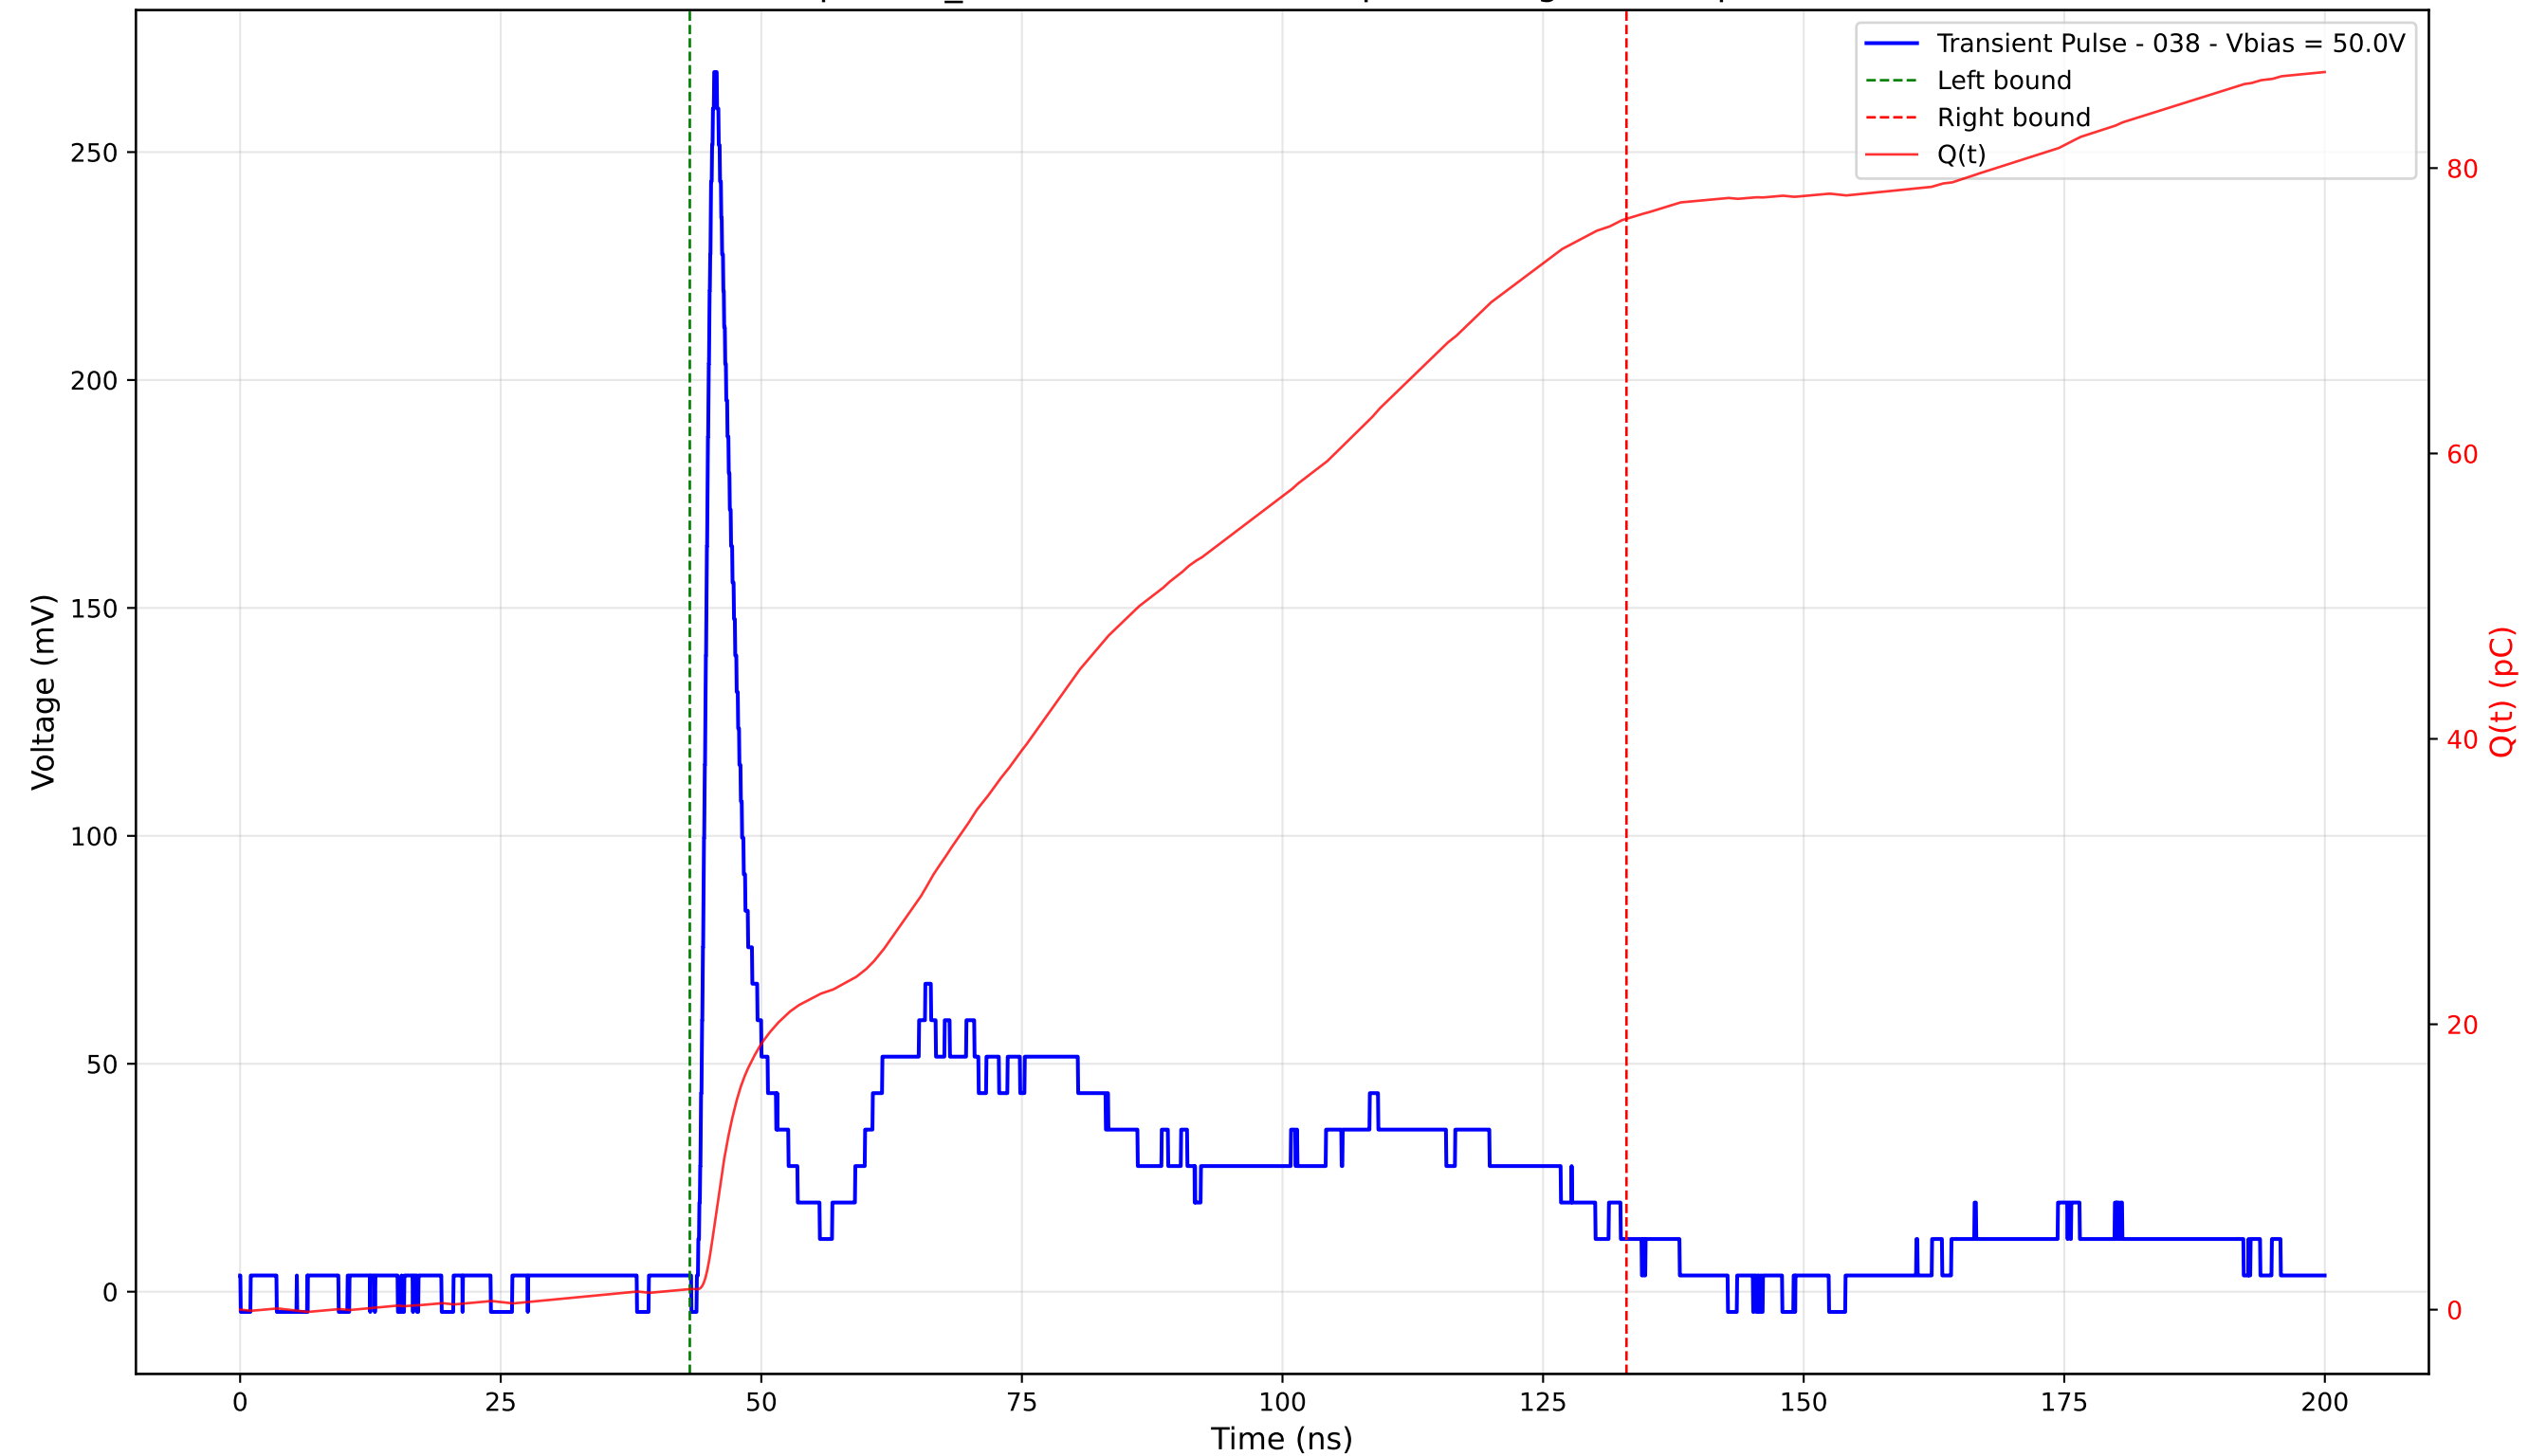


Transient Pulse - Sample: TD_4004 - Position: 250.0 μm - Charge: 79.05 pC - Rise Time: 1.07 ns

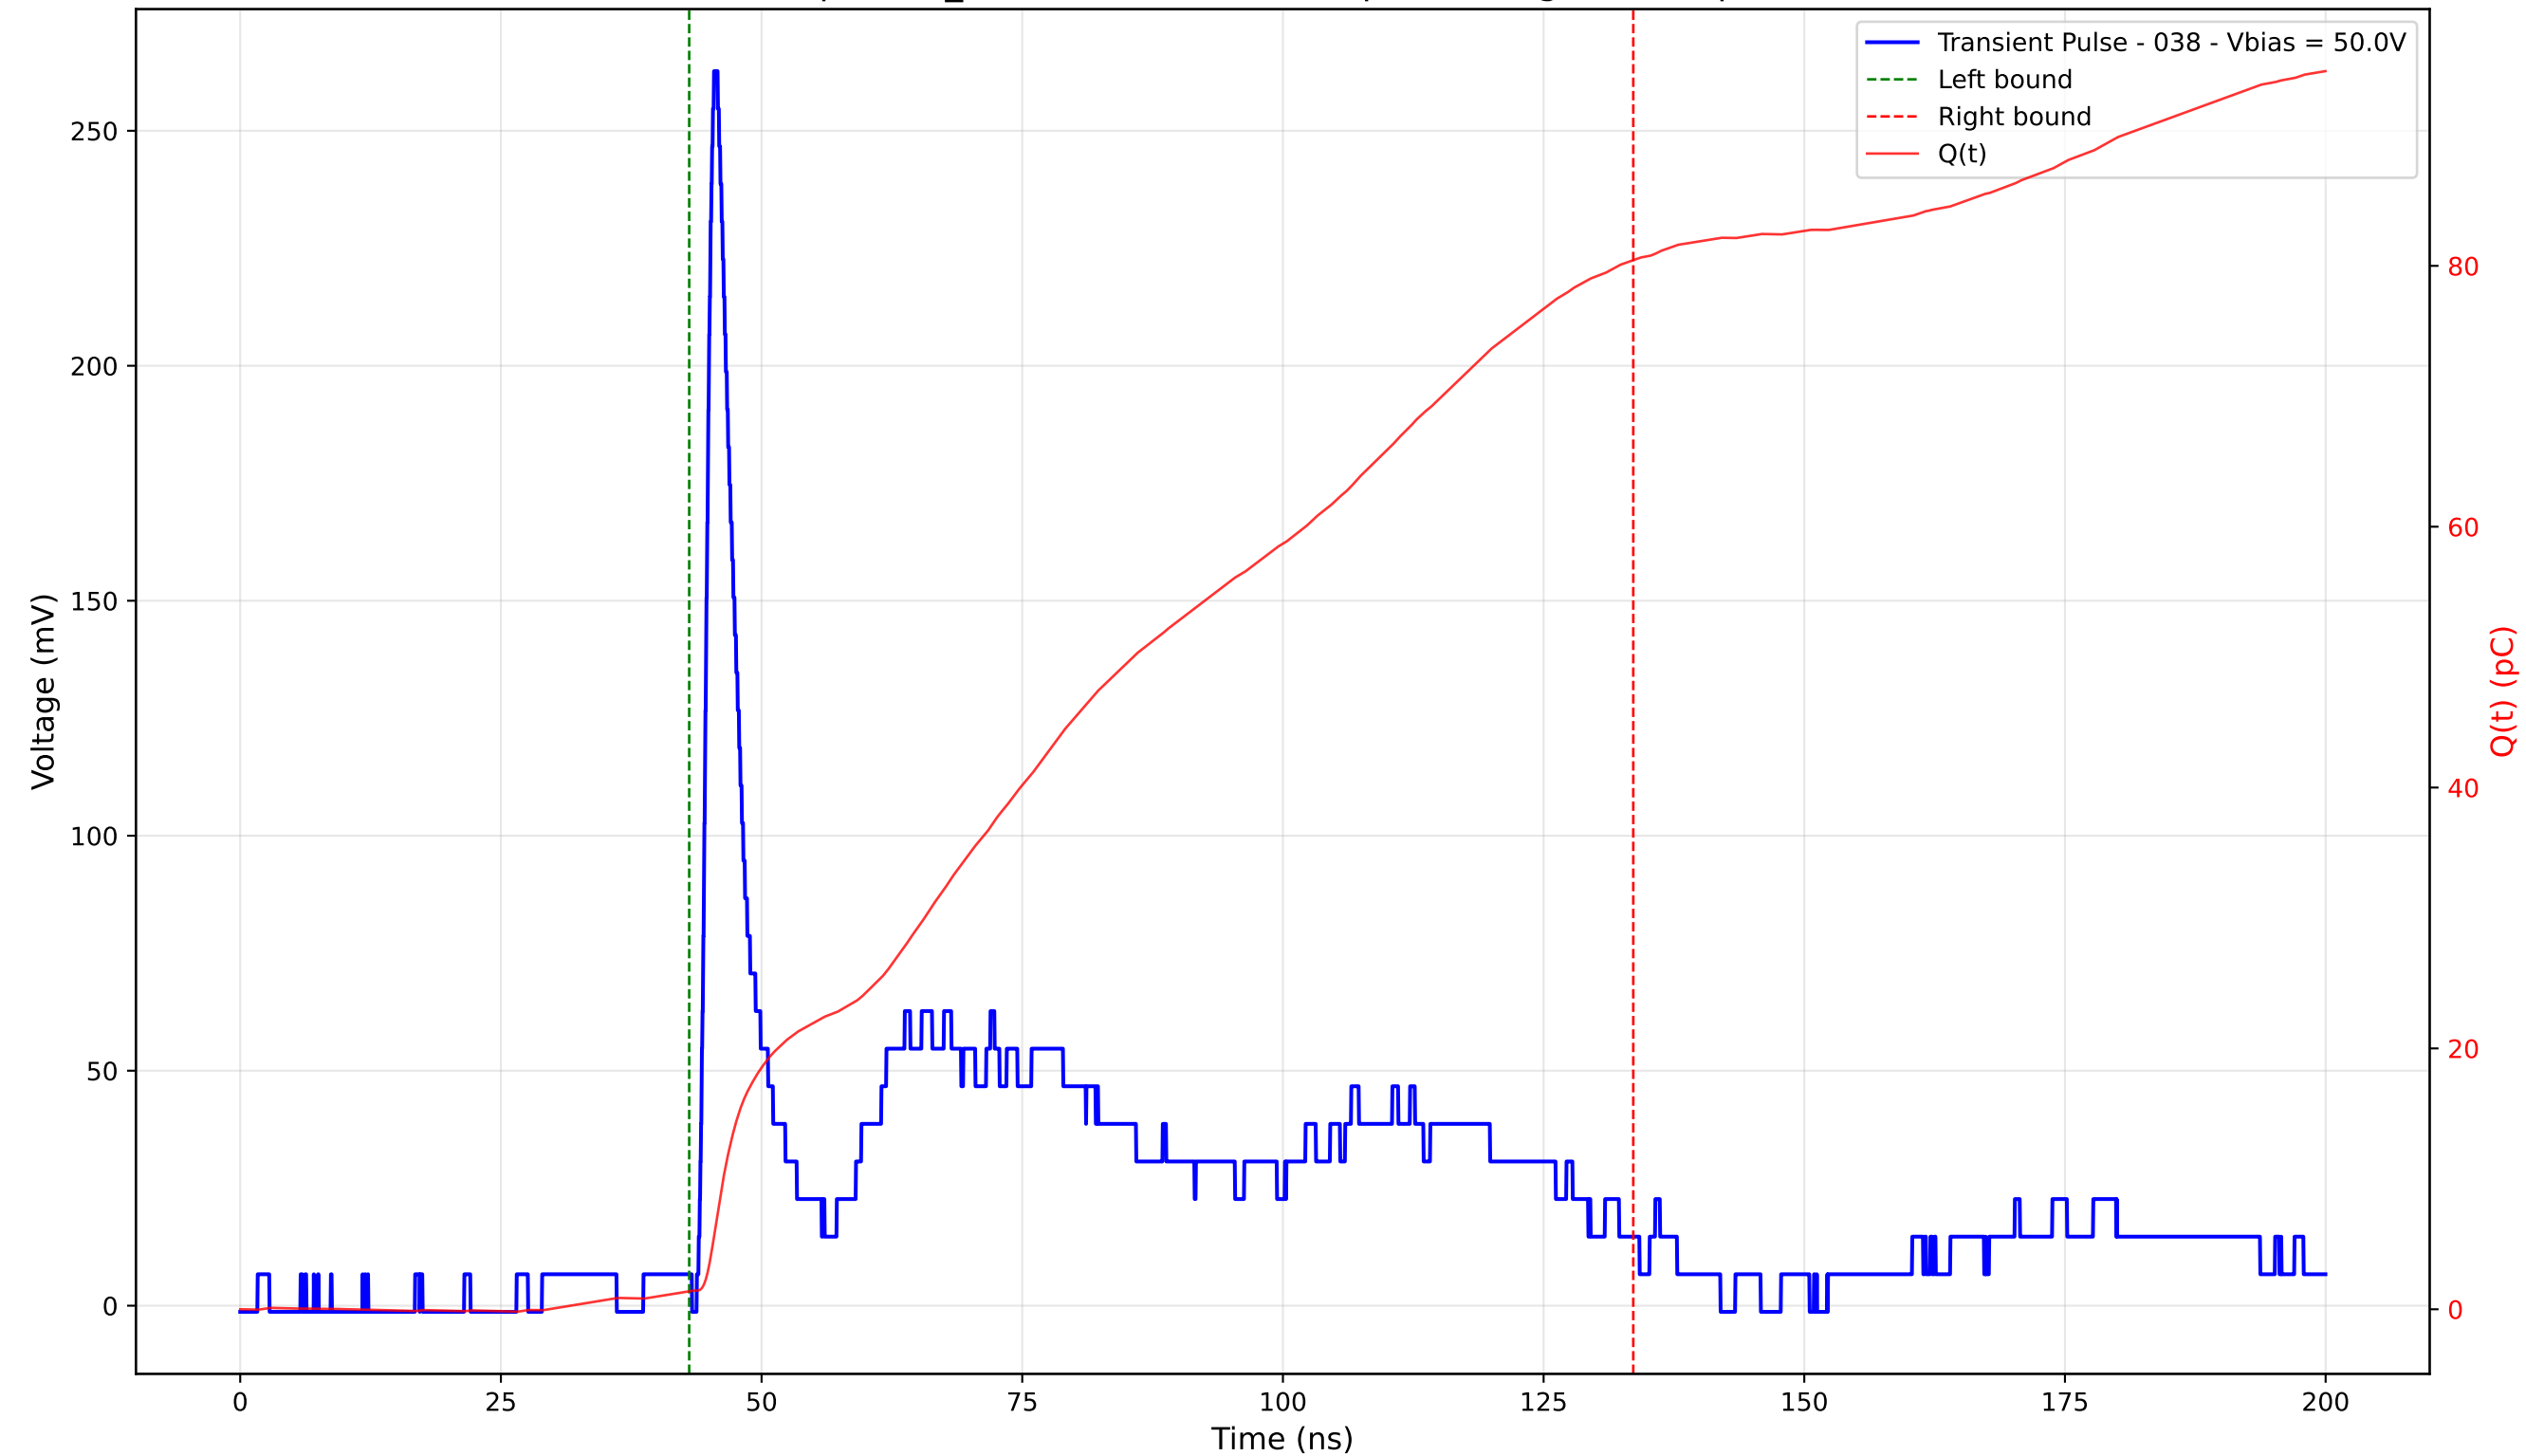


Transient Pulse - Sample: TD_4004 - Position: 255.0 μm - Charge: 66.87 pC - Rise Time: 1.00 ns

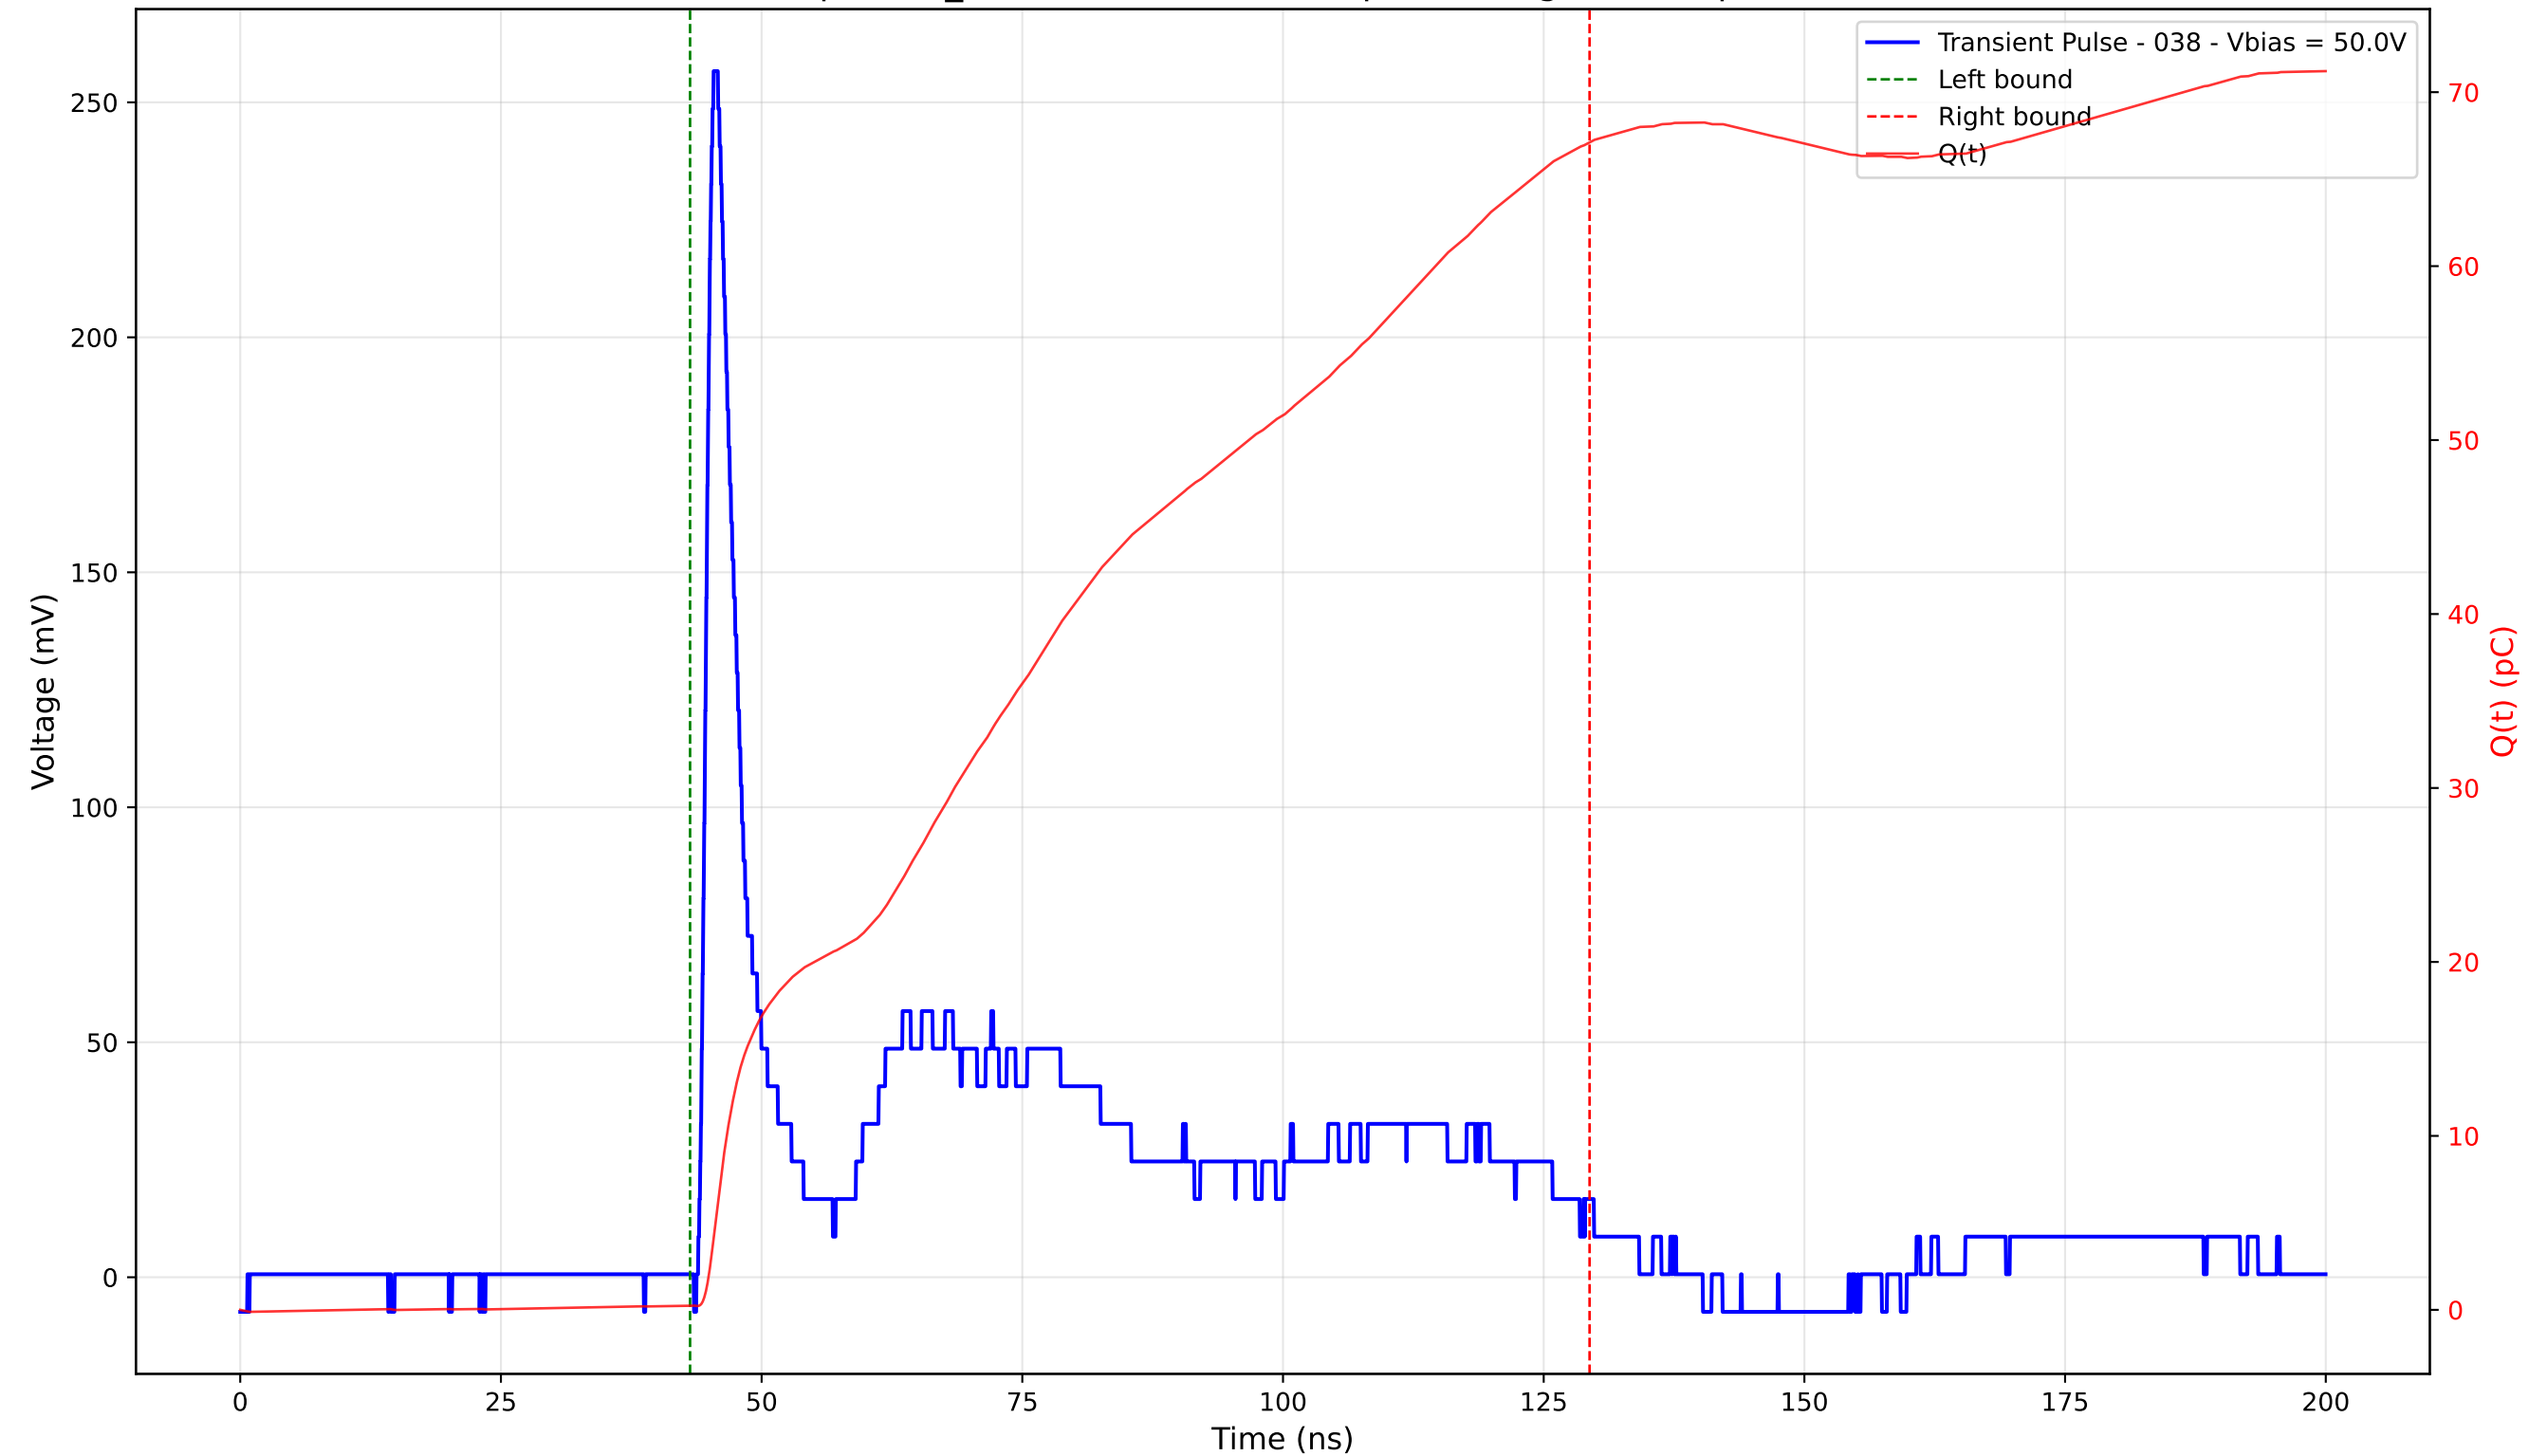


Transient Pulse - Sample: TD_4004 - Position: 260.0 μm - Charge: 69.53 pC - Rise Time: 1.03 ns

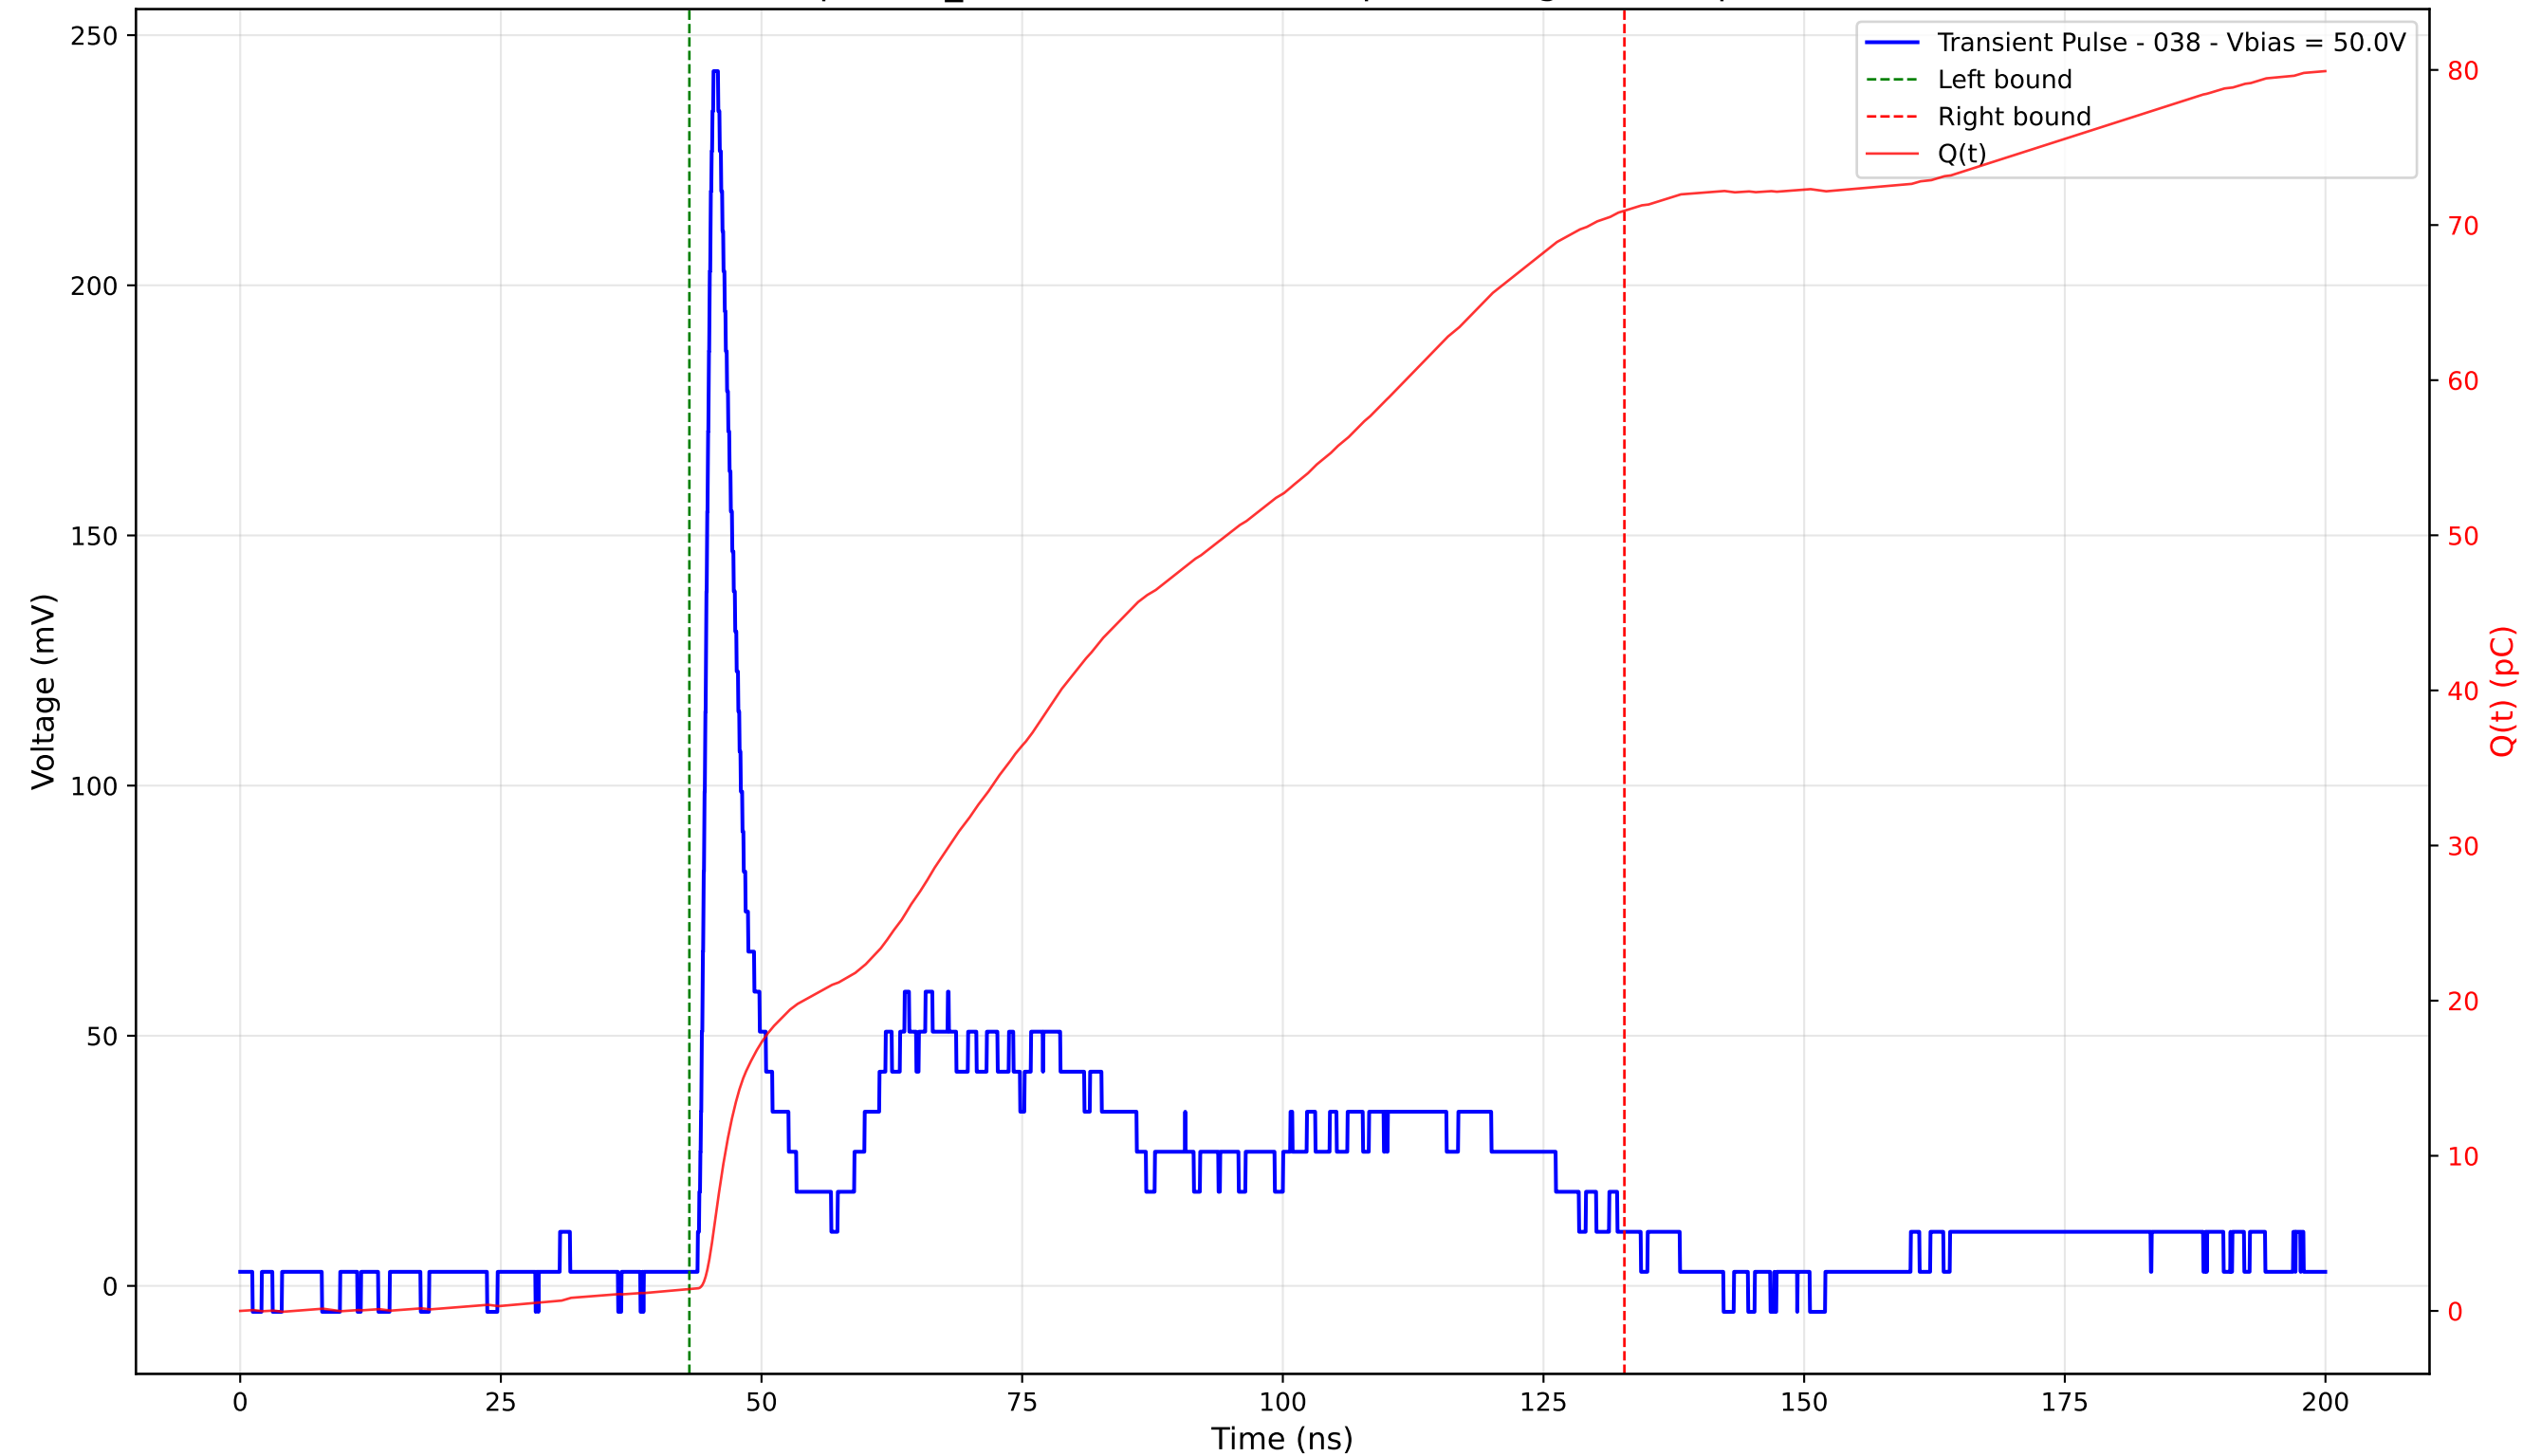


Transient Pulse - Sample: TD_4004 - Position: 265.0 μm - Charge: 16.83 pC - Rise Time: 1.05 ns

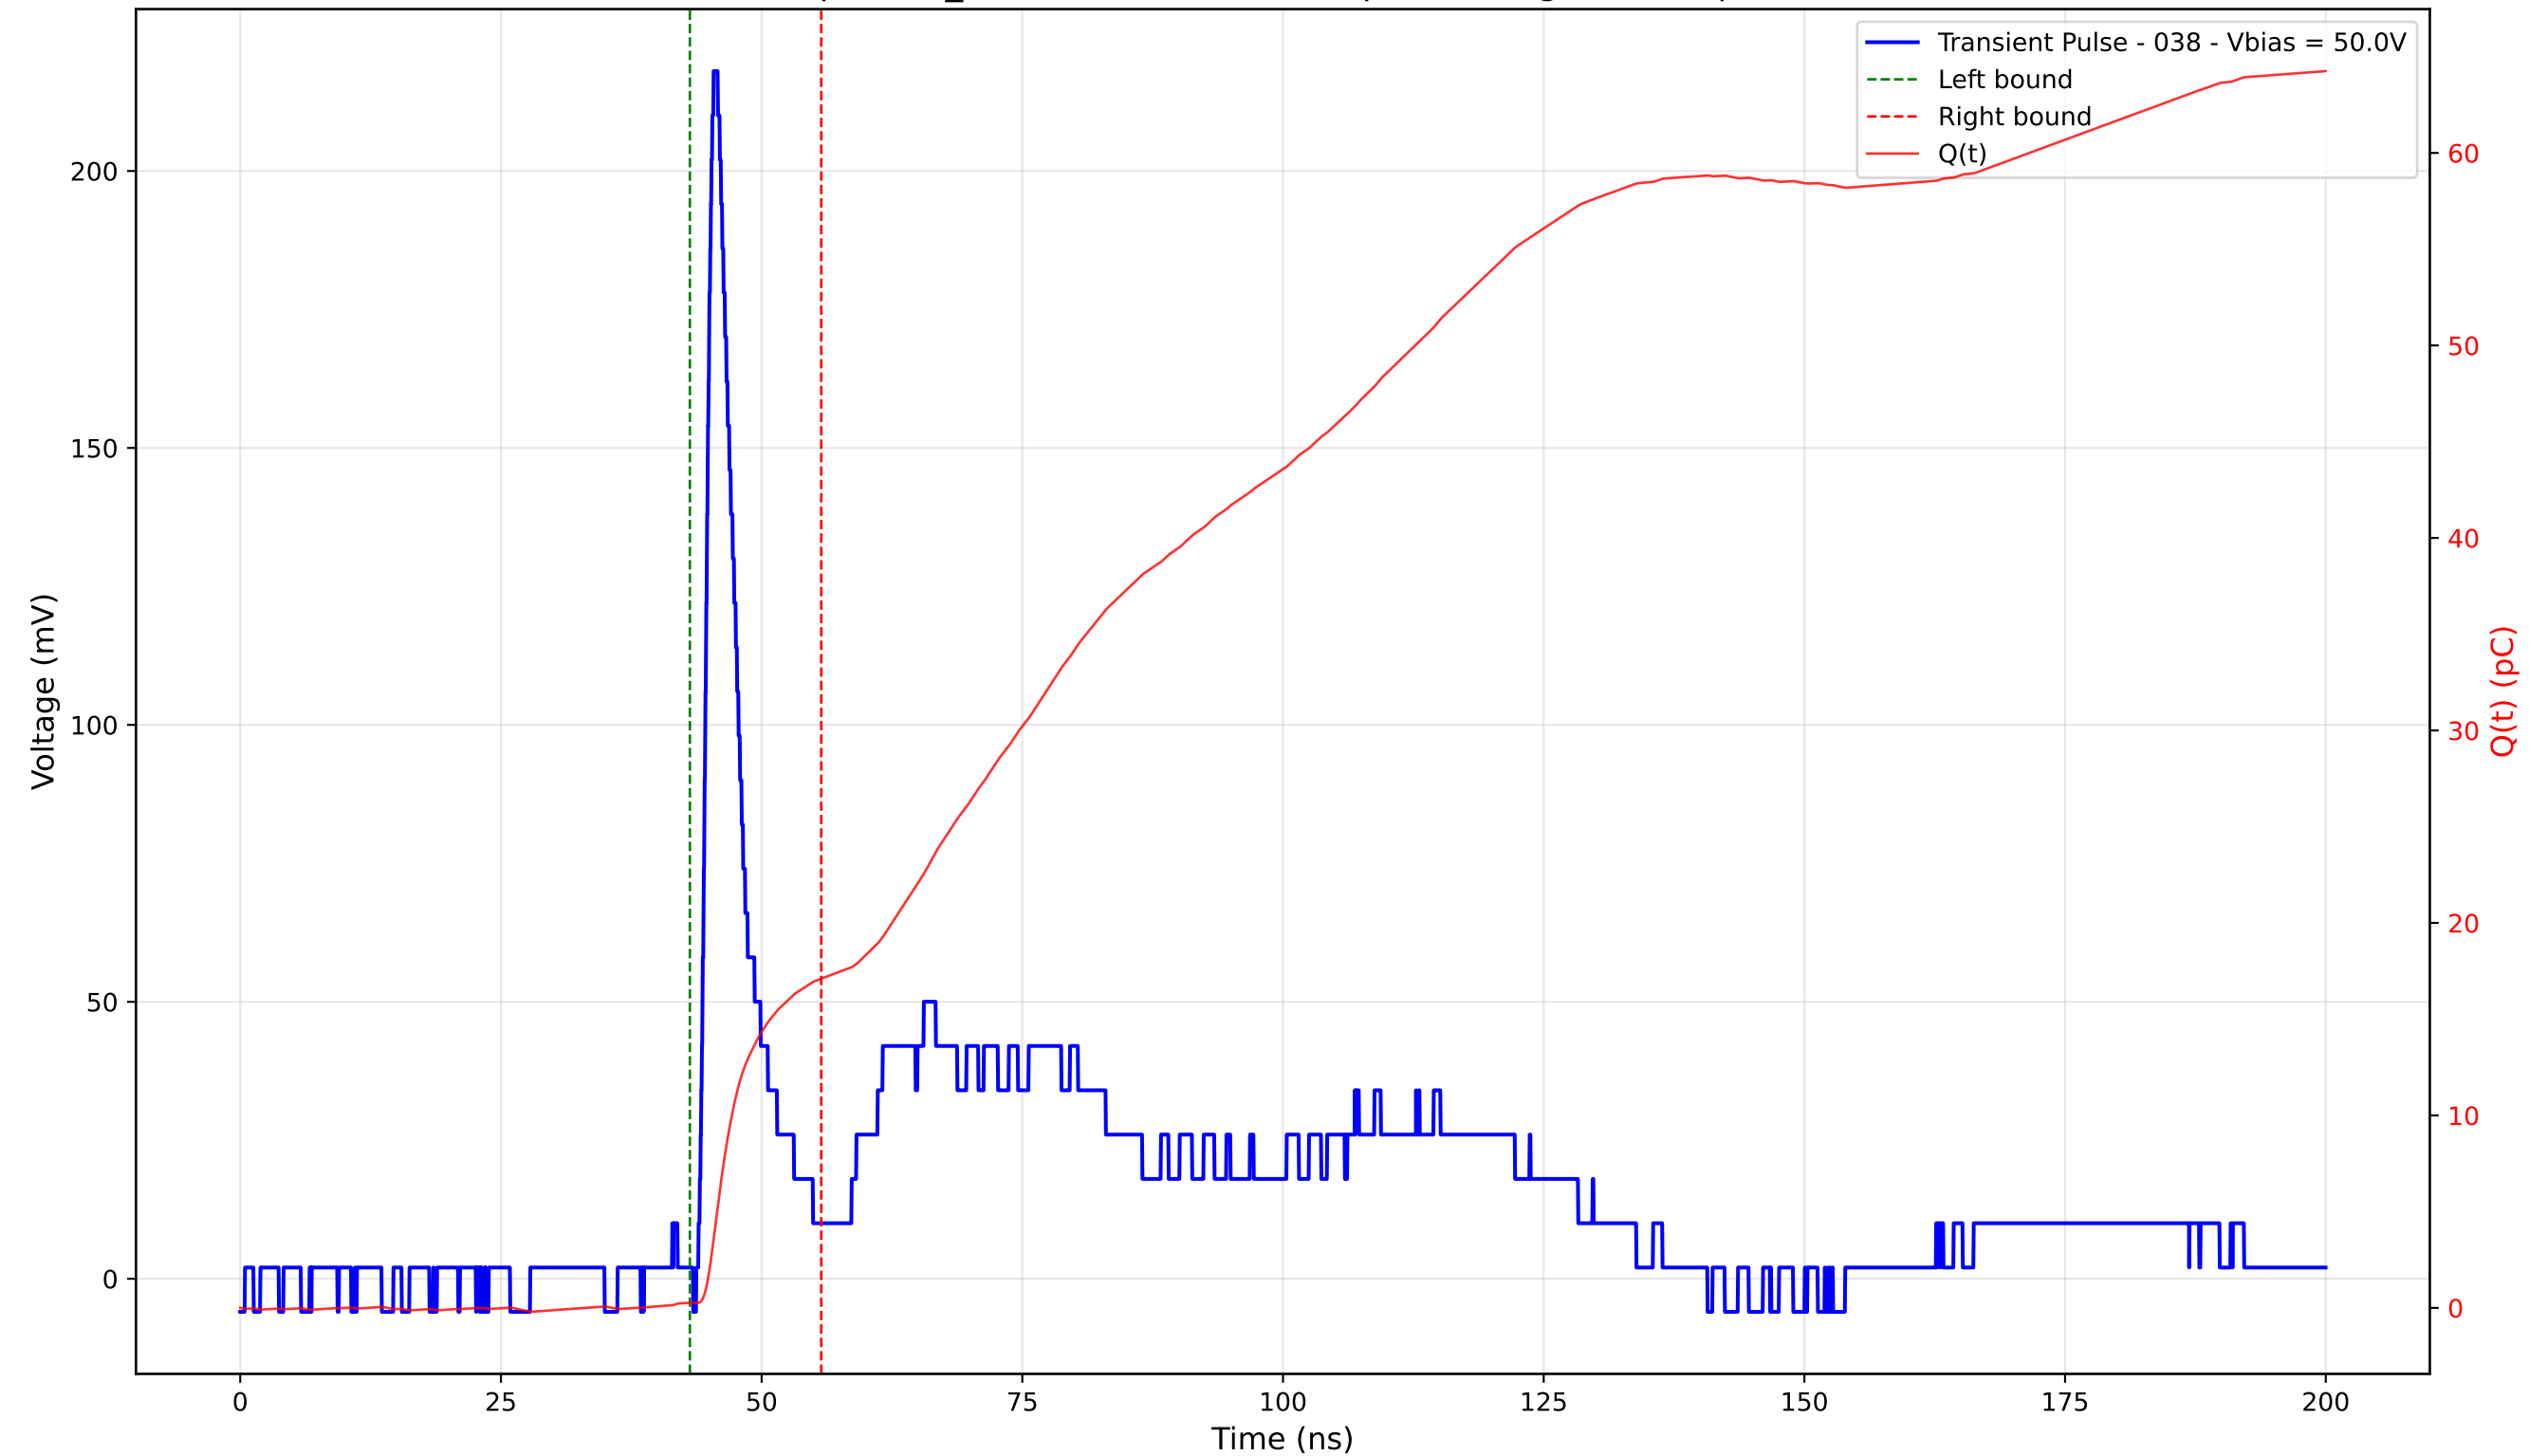


Transient Pulse - Sample: TD_4004 - Position: 270.0 μm - Charge: 15.78 pC - Rise Time: 0.99 ns

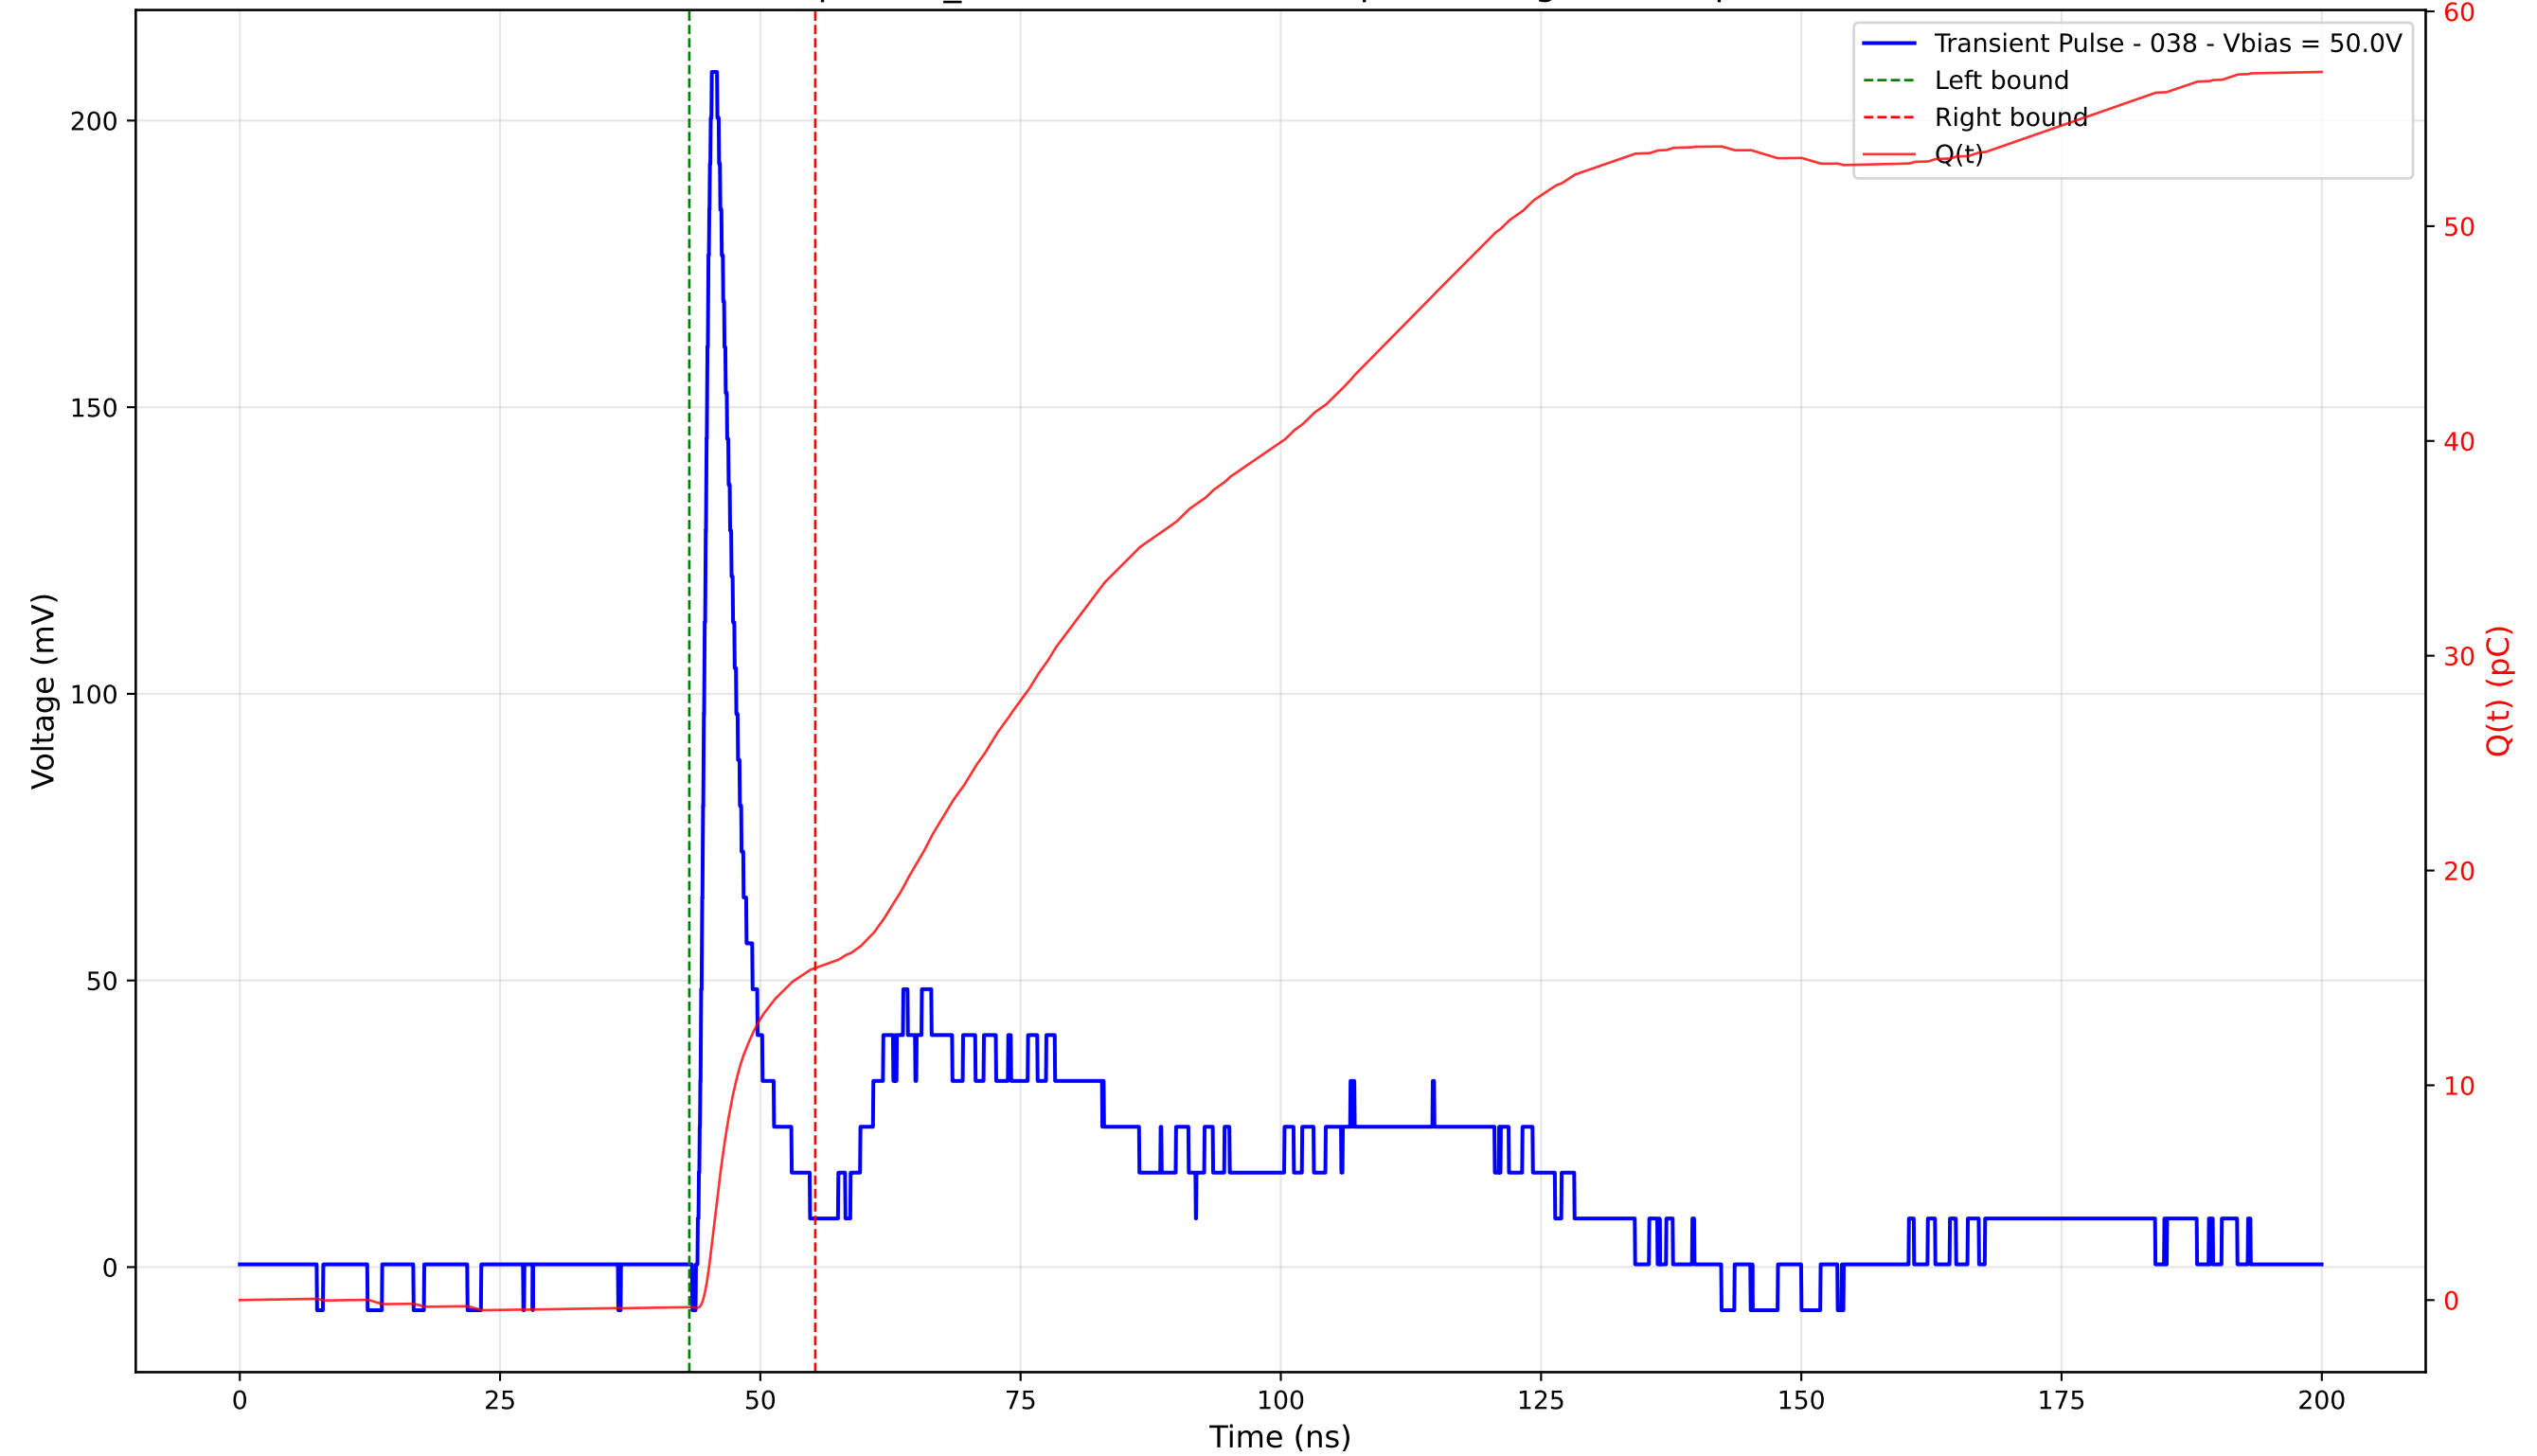


Transient Pulse - Sample: TD_4004 - Position: 275.0 μm - Charge: 64.99 pC - Rise Time: 1.07 ns

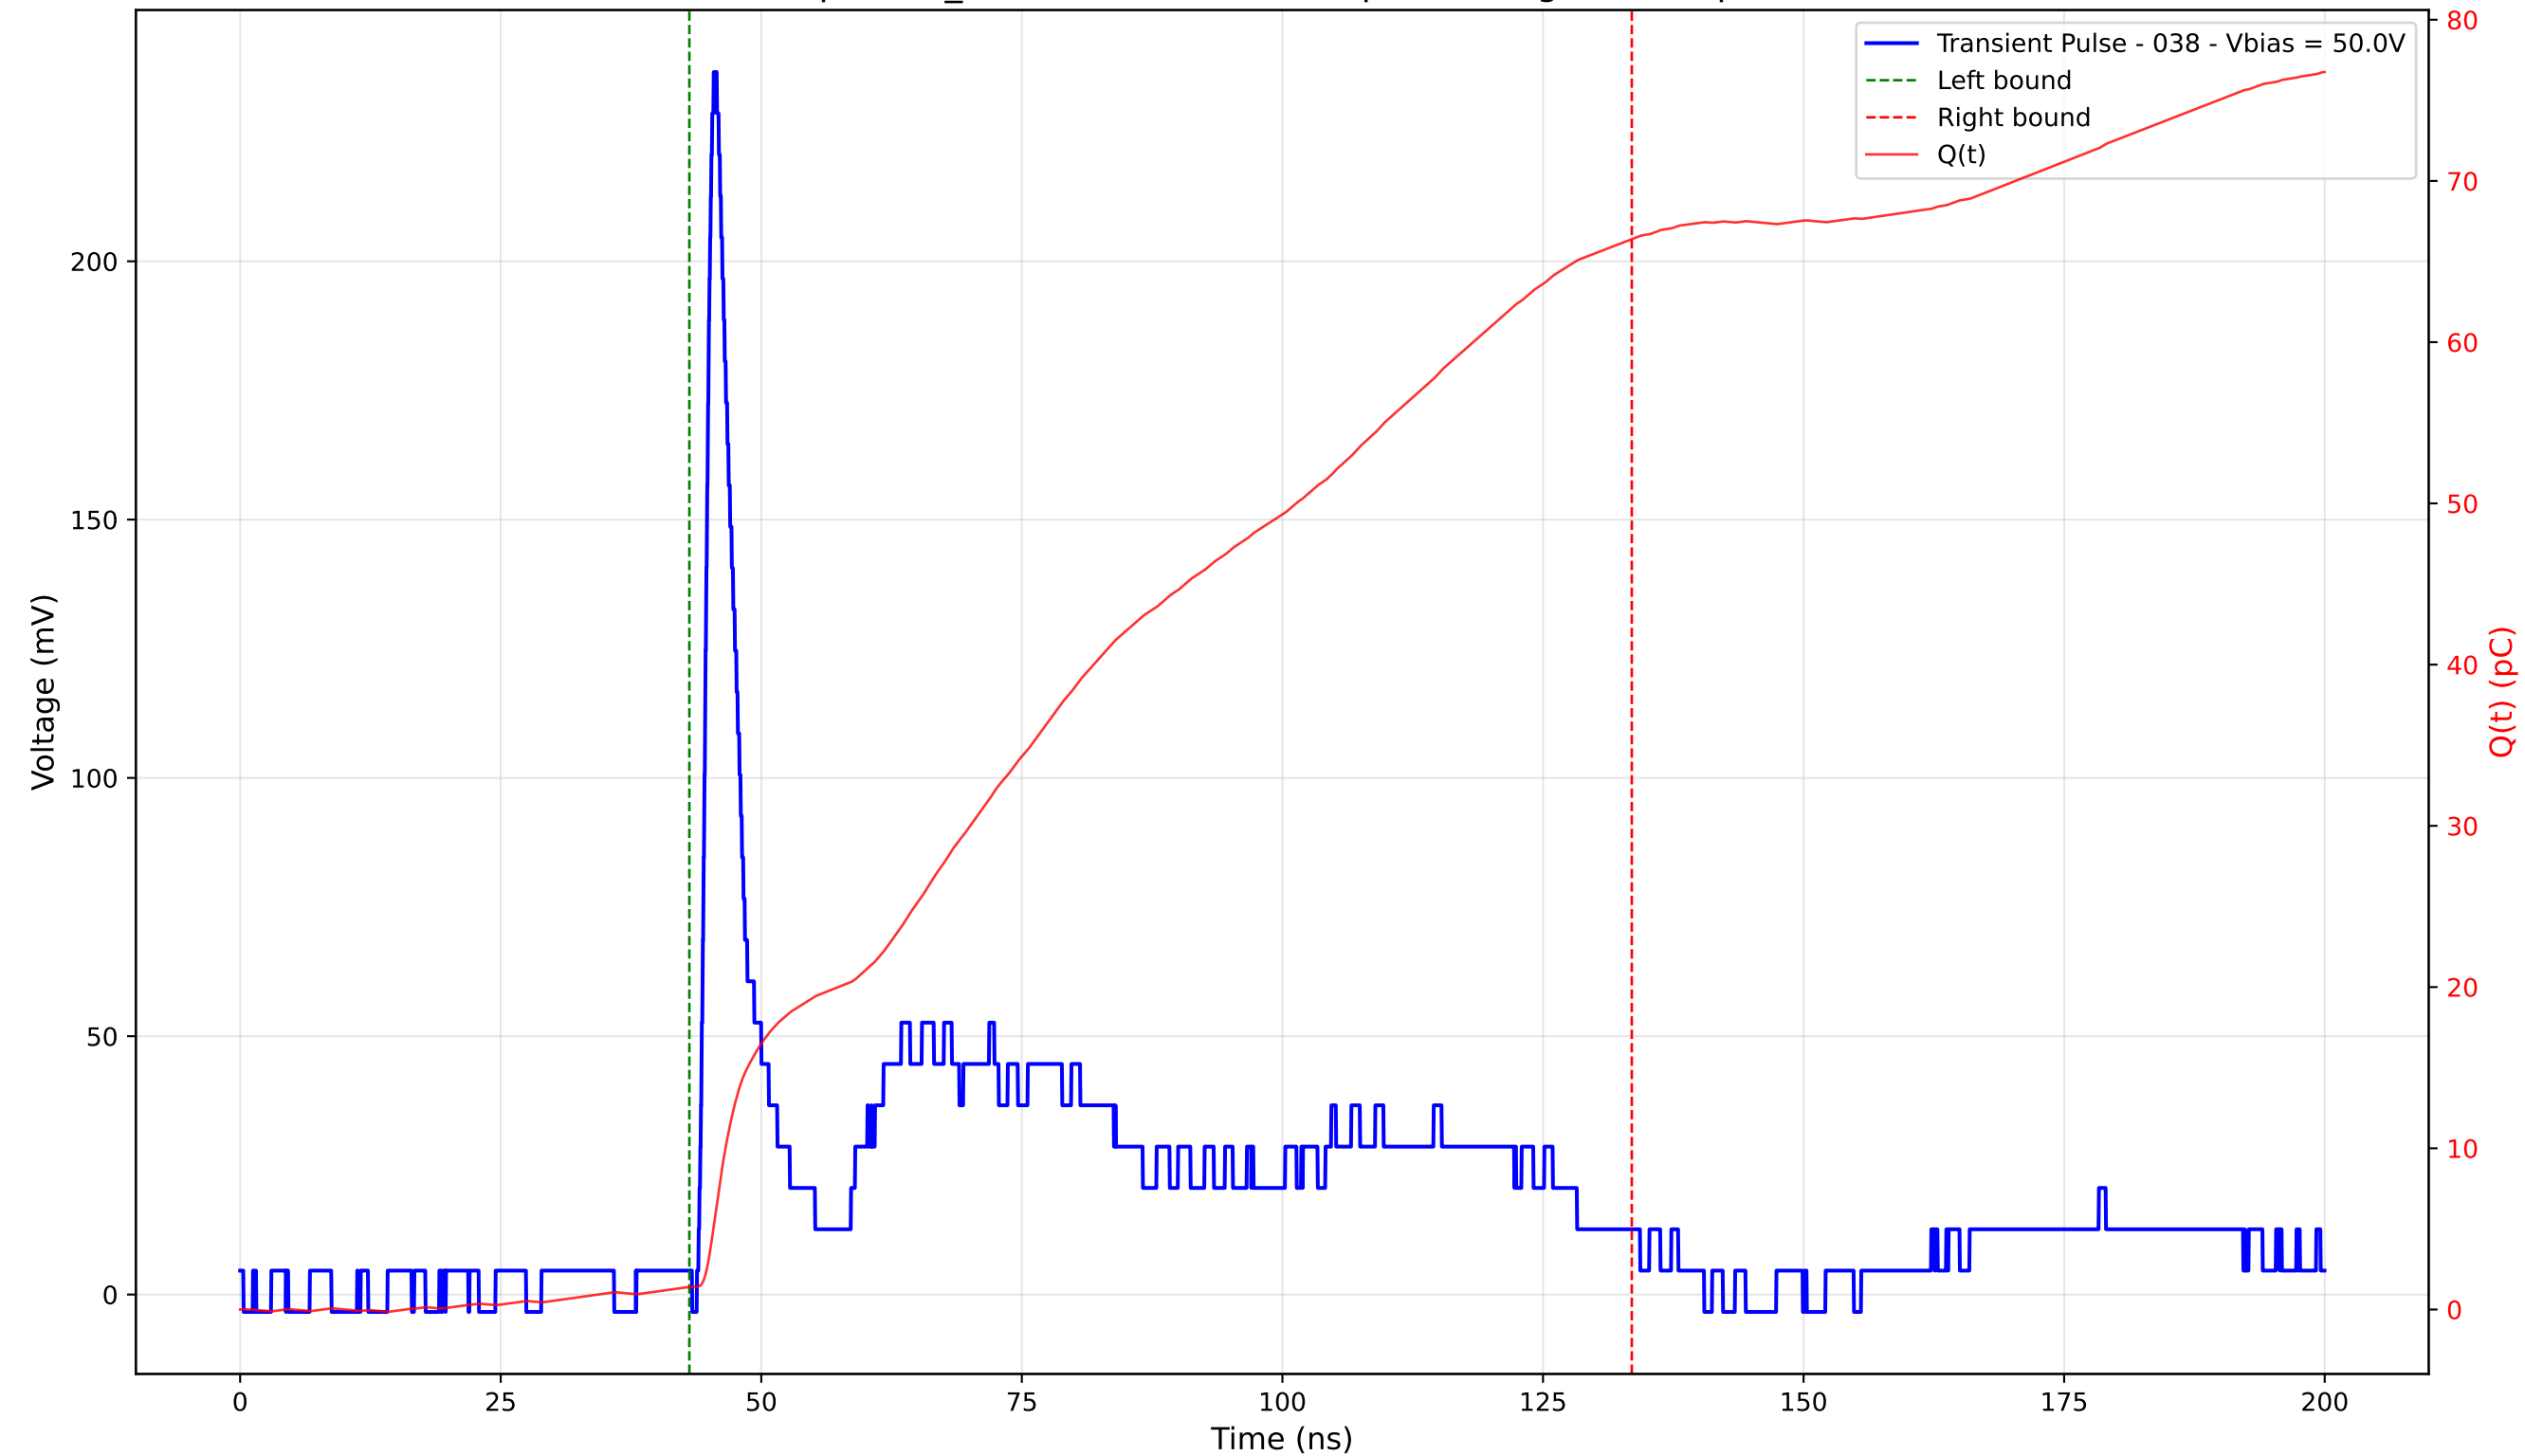


Transient Pulse - Sample: TD_4004 - Position: 280.0 μm - Charge: 63.87 pC - Rise Time: 0.98 ns

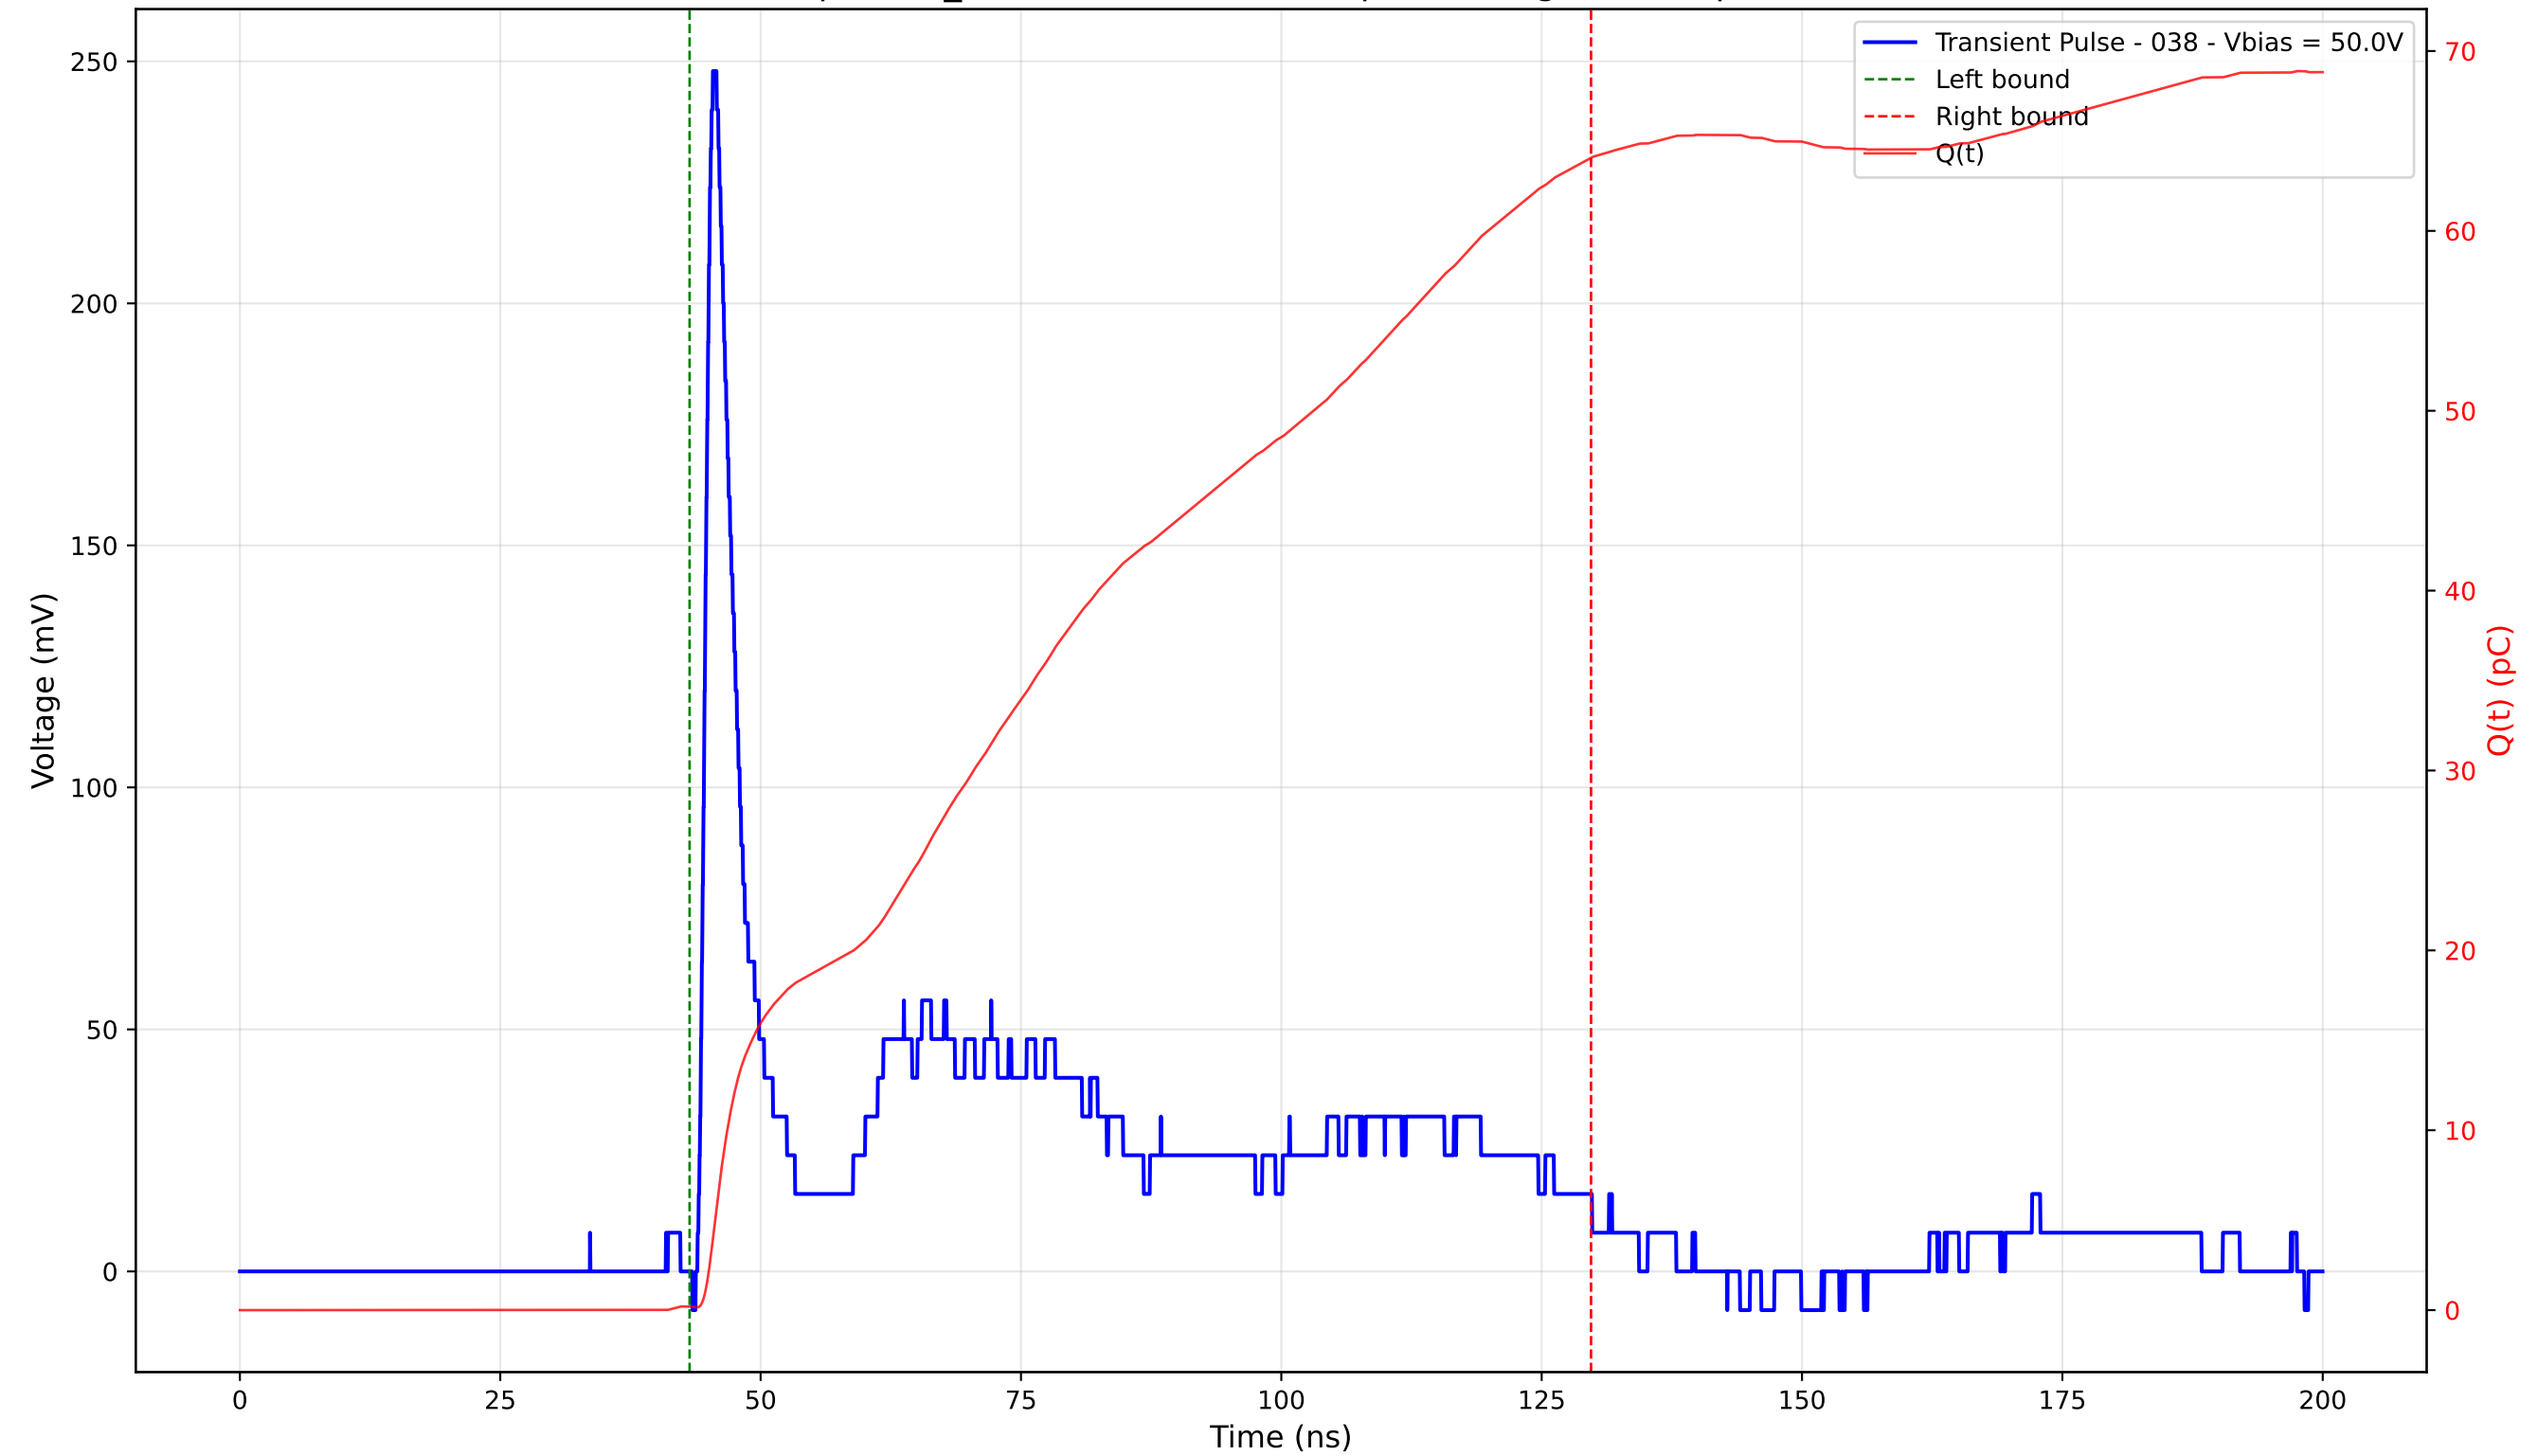


Transient Pulse - Sample: TD_4004 - Position: 285.0 μm - Charge: 17.02 pC - Rise Time: 1.08 ns

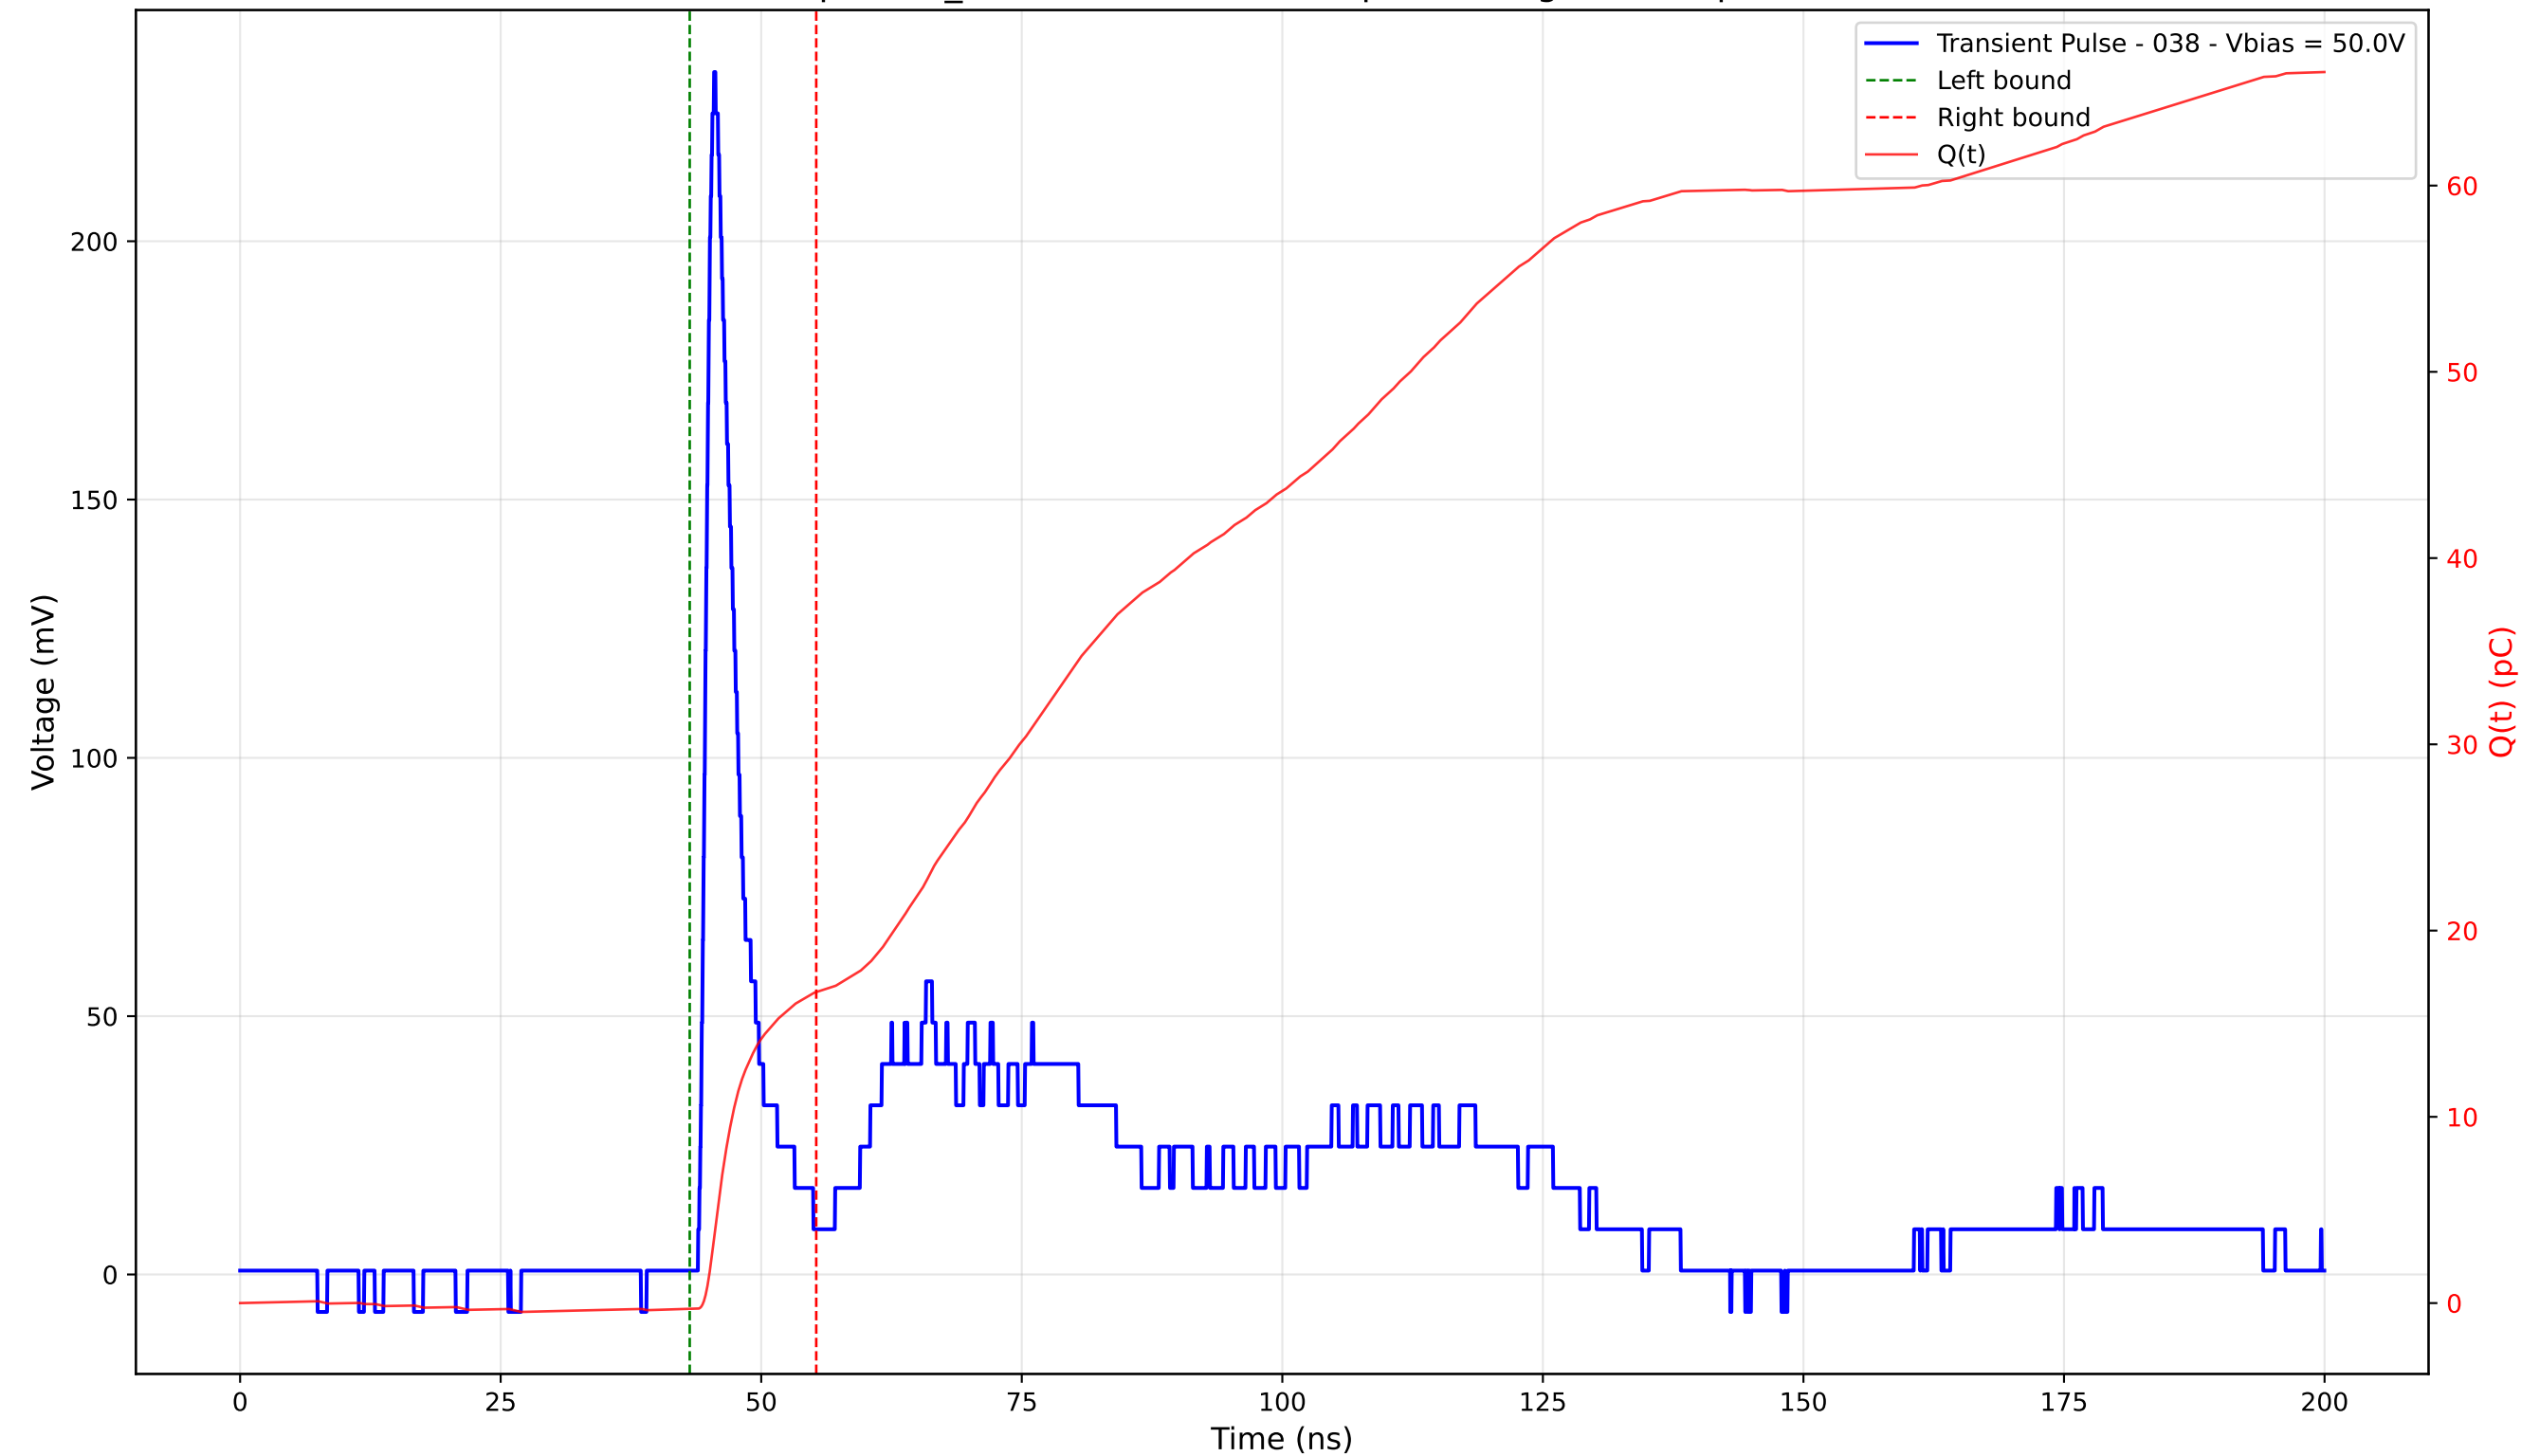


Transient Pulse - Sample: TD_4004 - Position: 290.0 μm - Charge: 56.38 pC - Rise Time: 1.02 ns

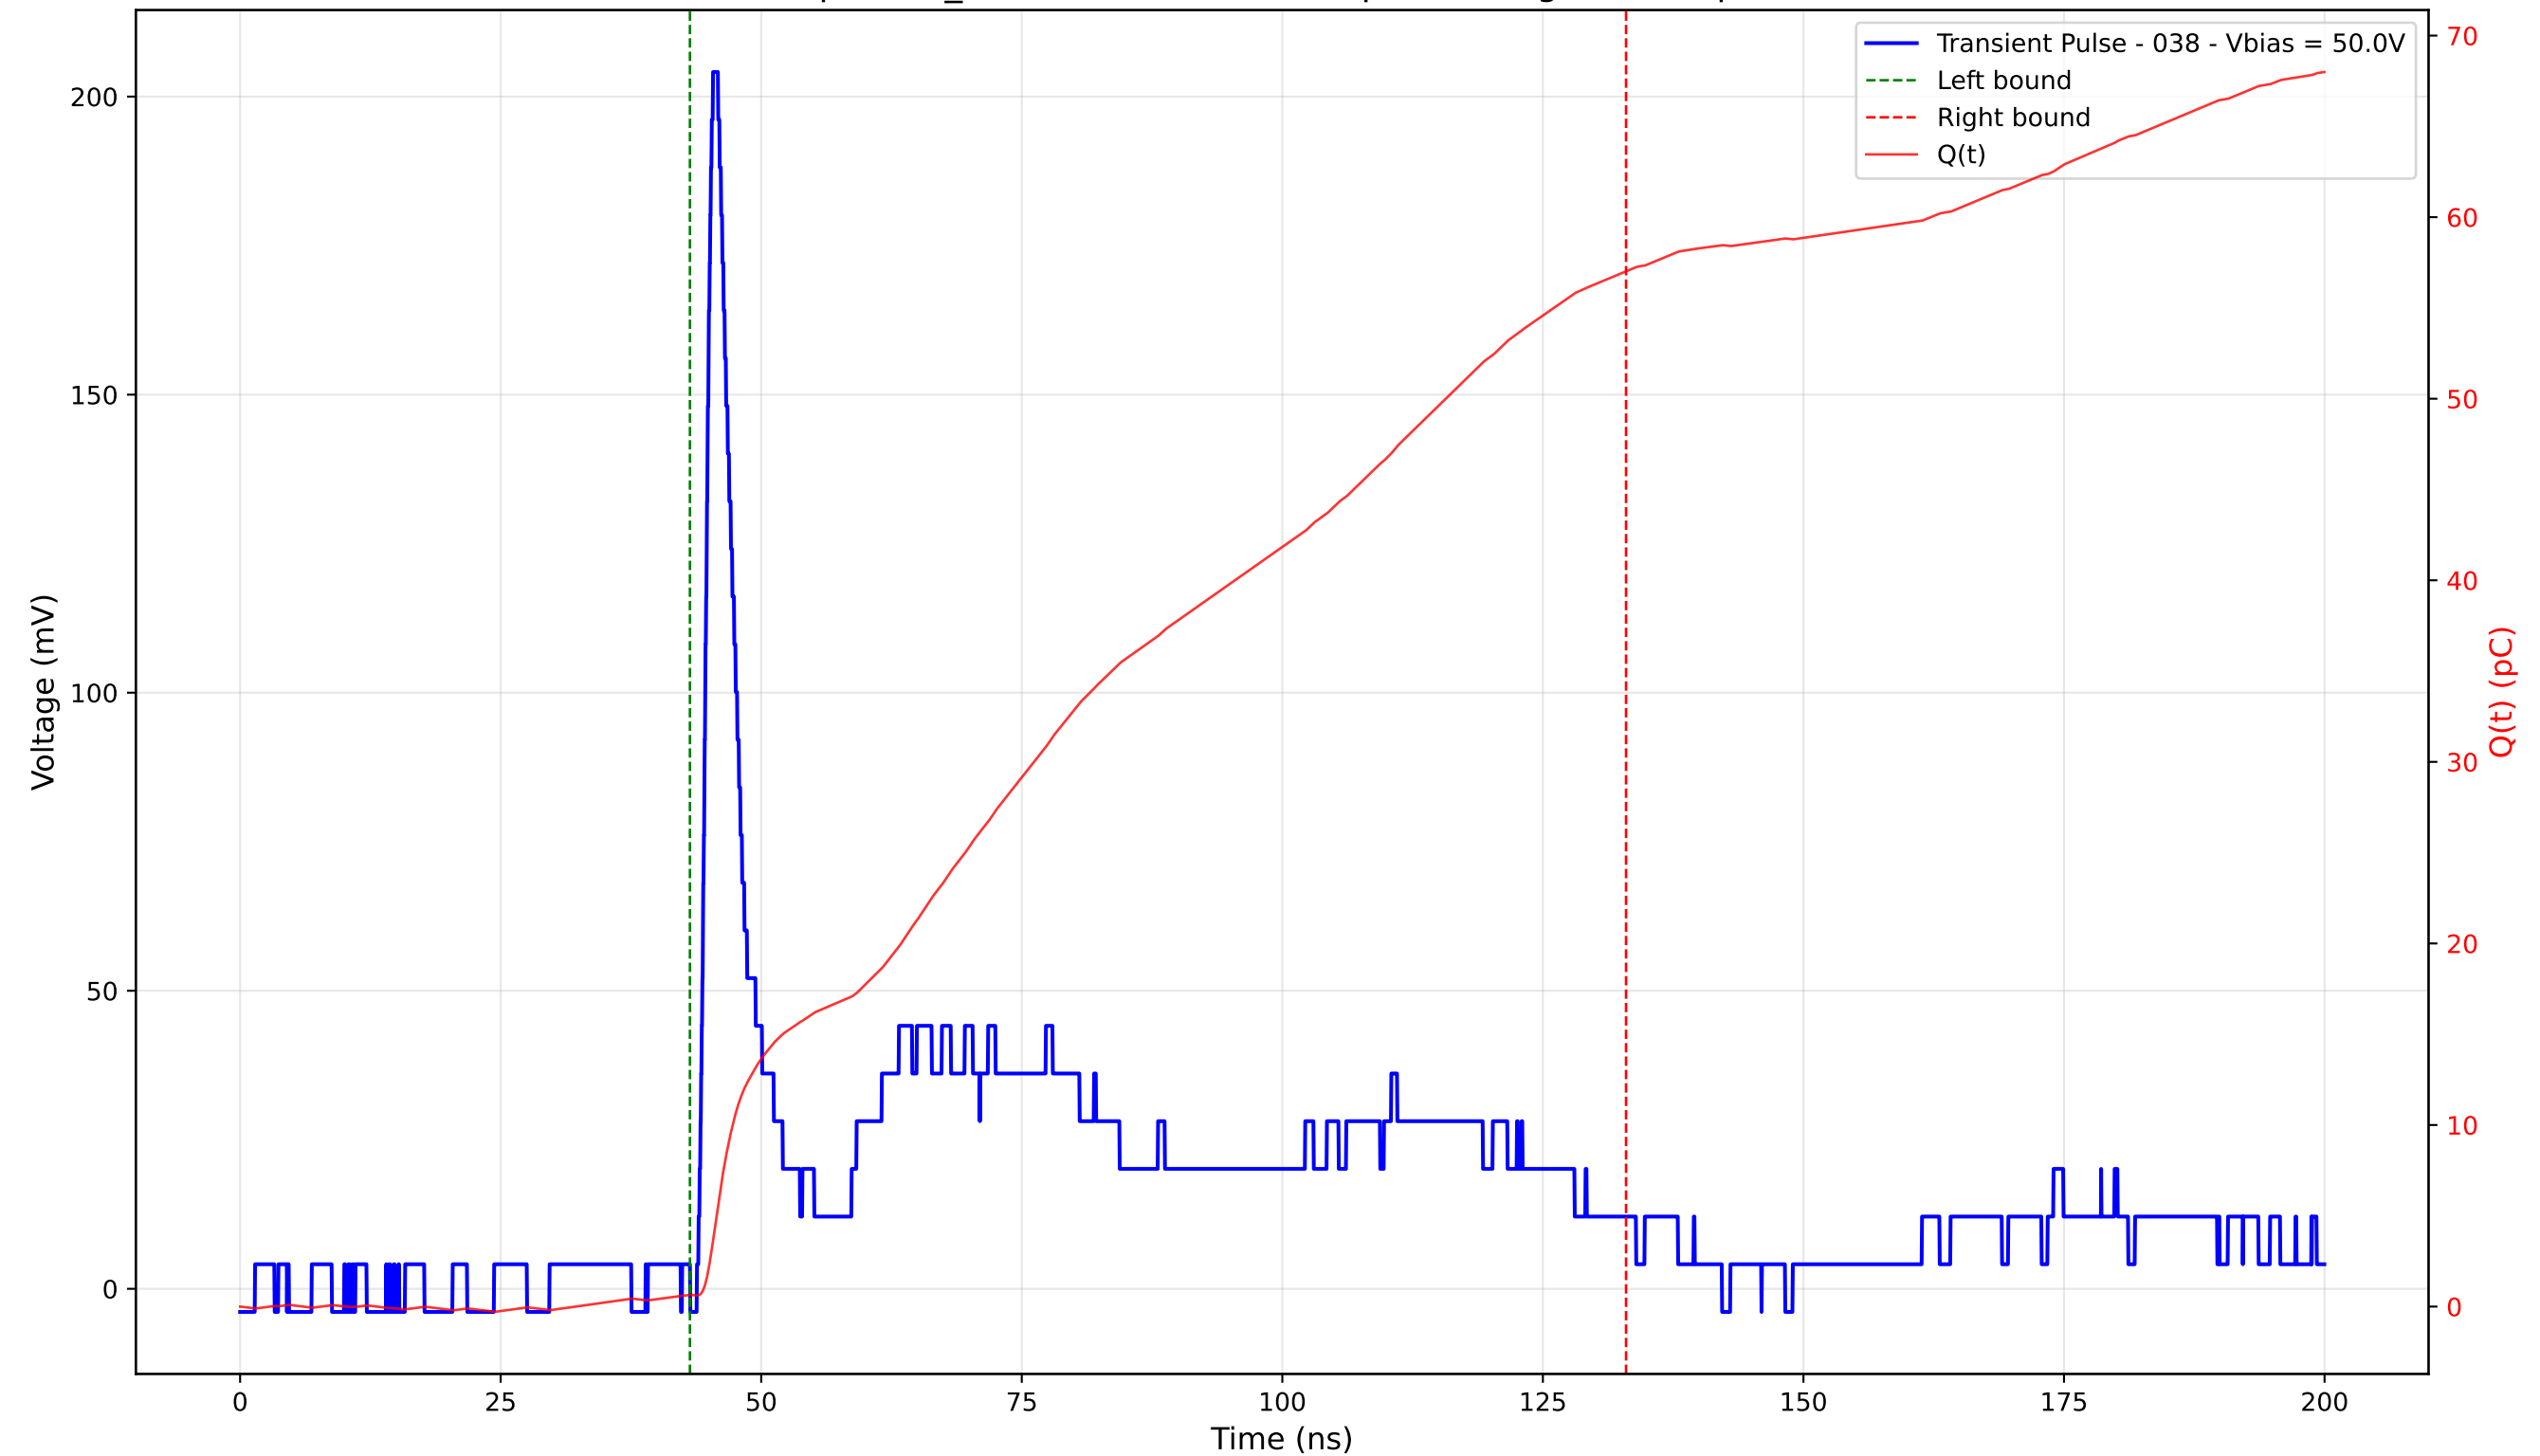


Transient Pulse - Sample: TD_4004 - Position: 295.0 μm - Charge: 13.77 pC - Rise Time: 1.02 ns

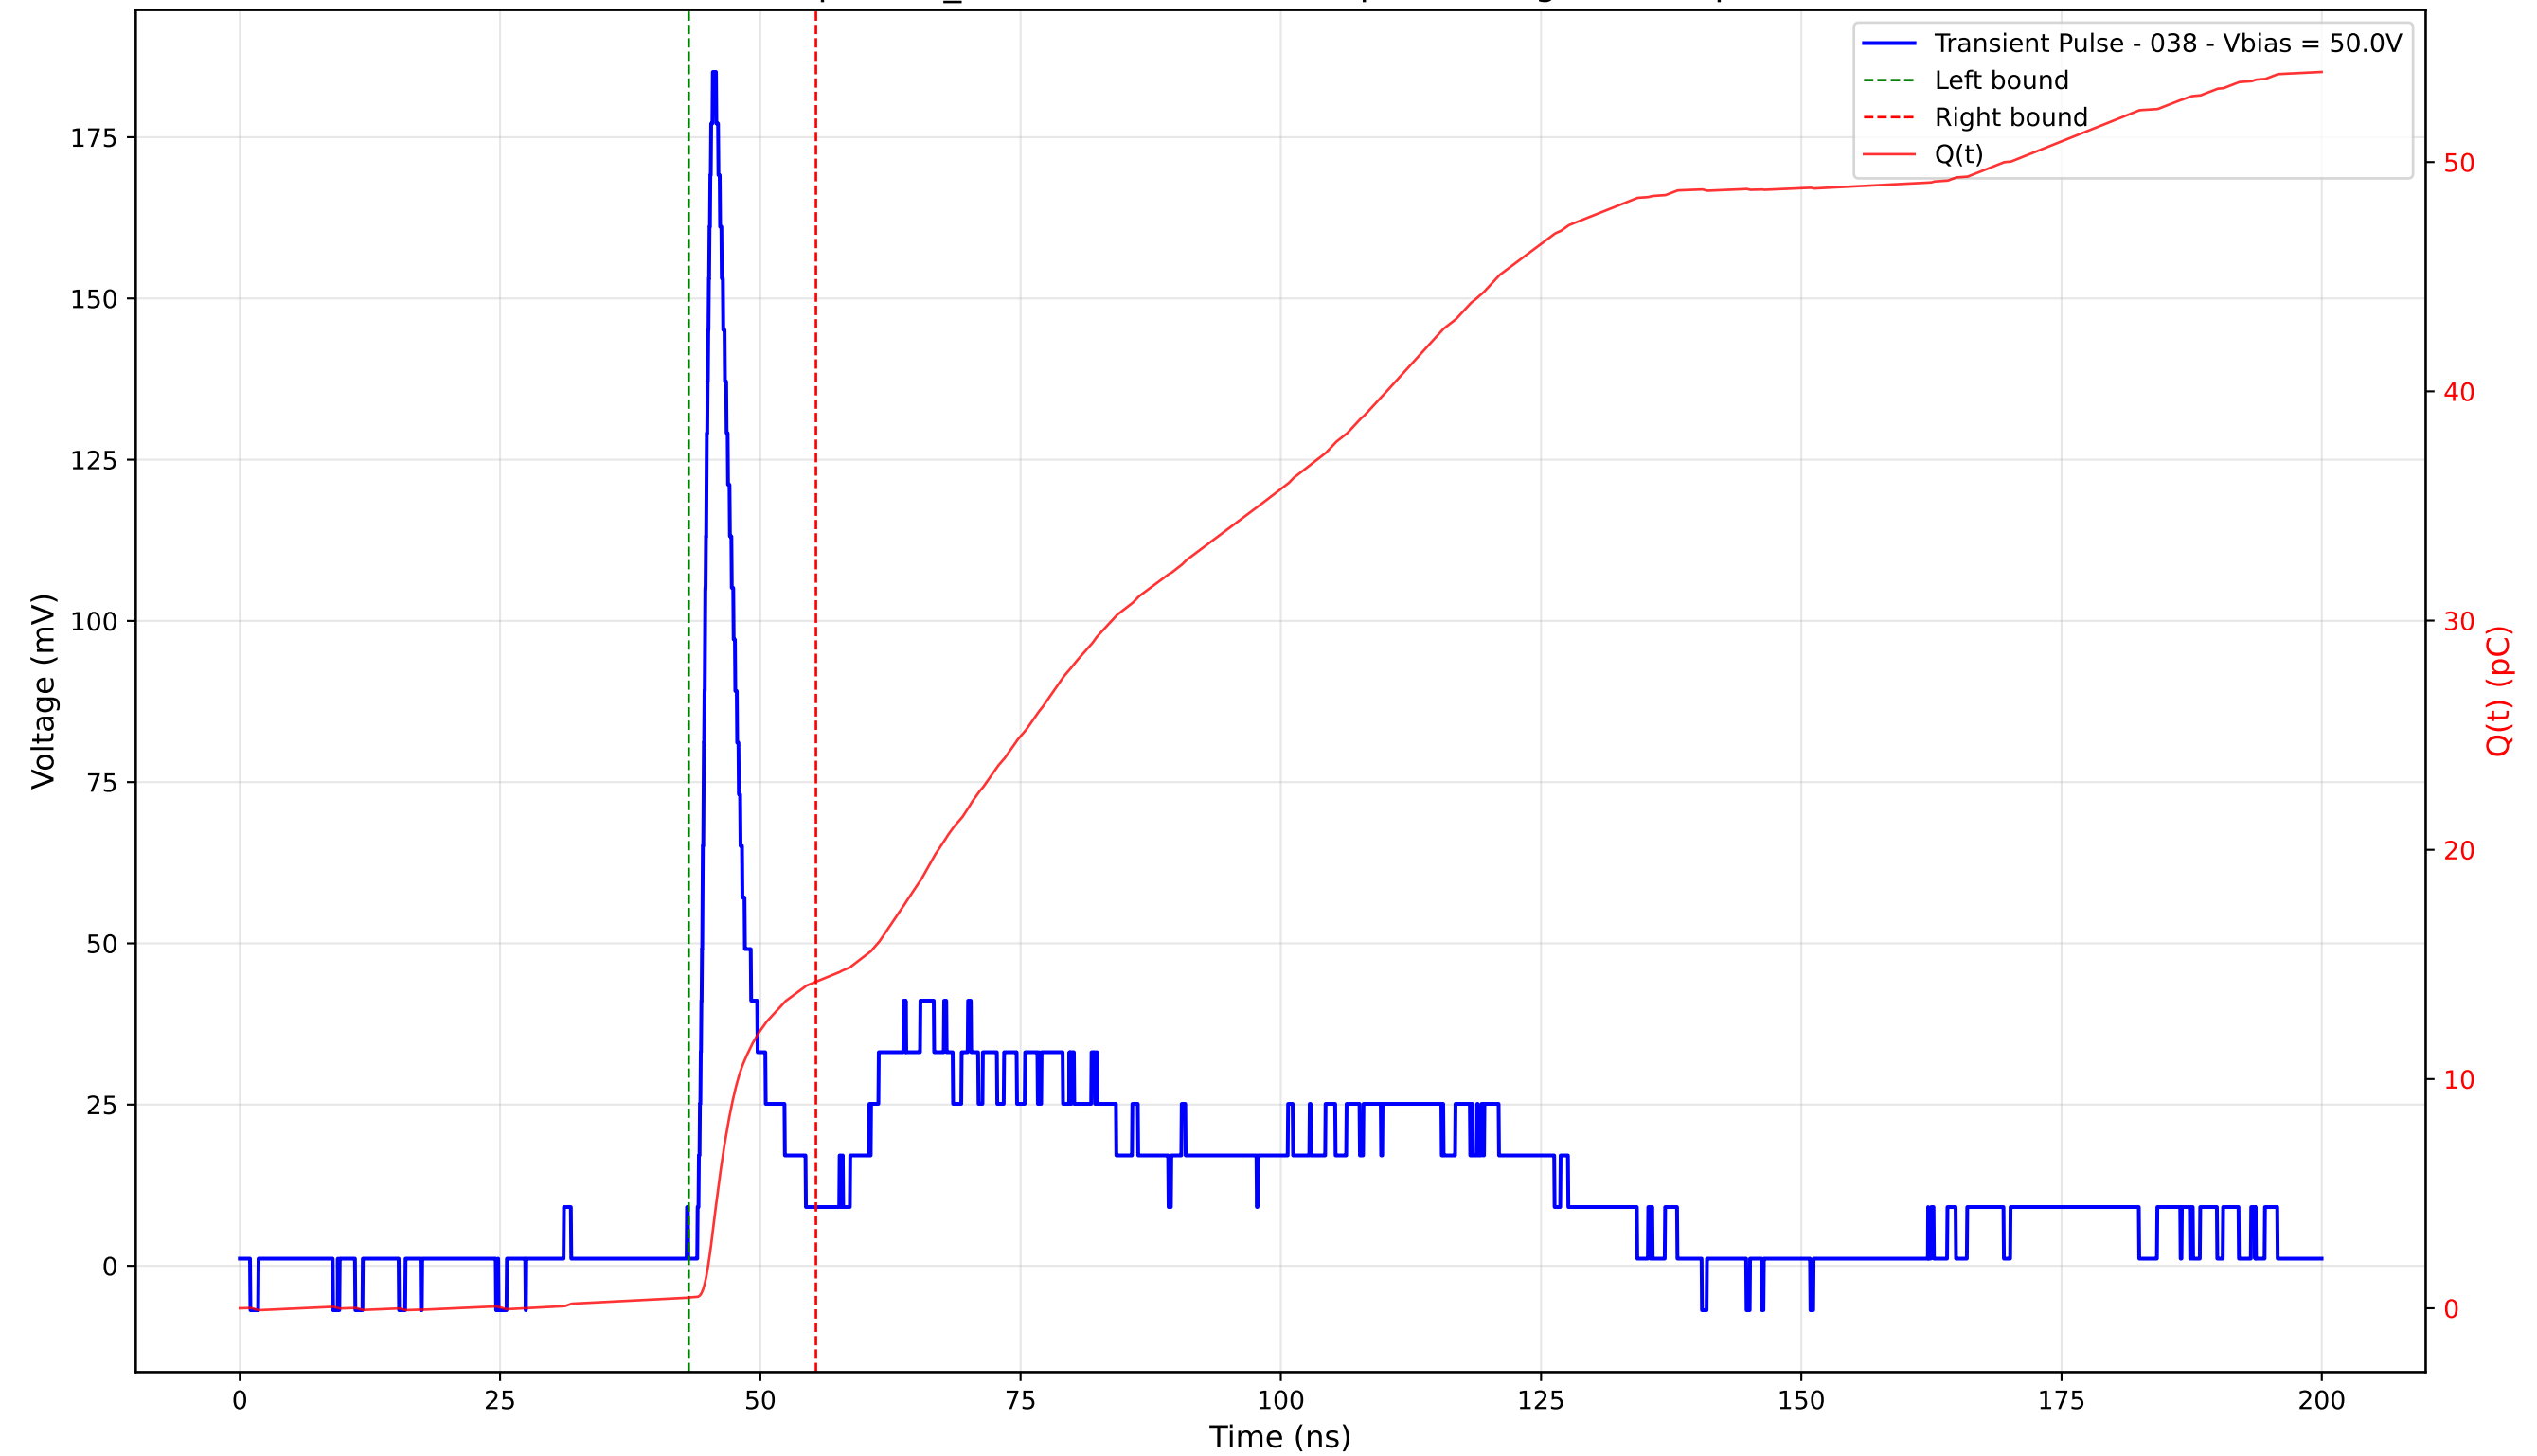


Transient Pulse - Sample: TD_4004 - Position: 300.0 μm - Charge: 13.49 pC - Rise Time: 1.03 ns

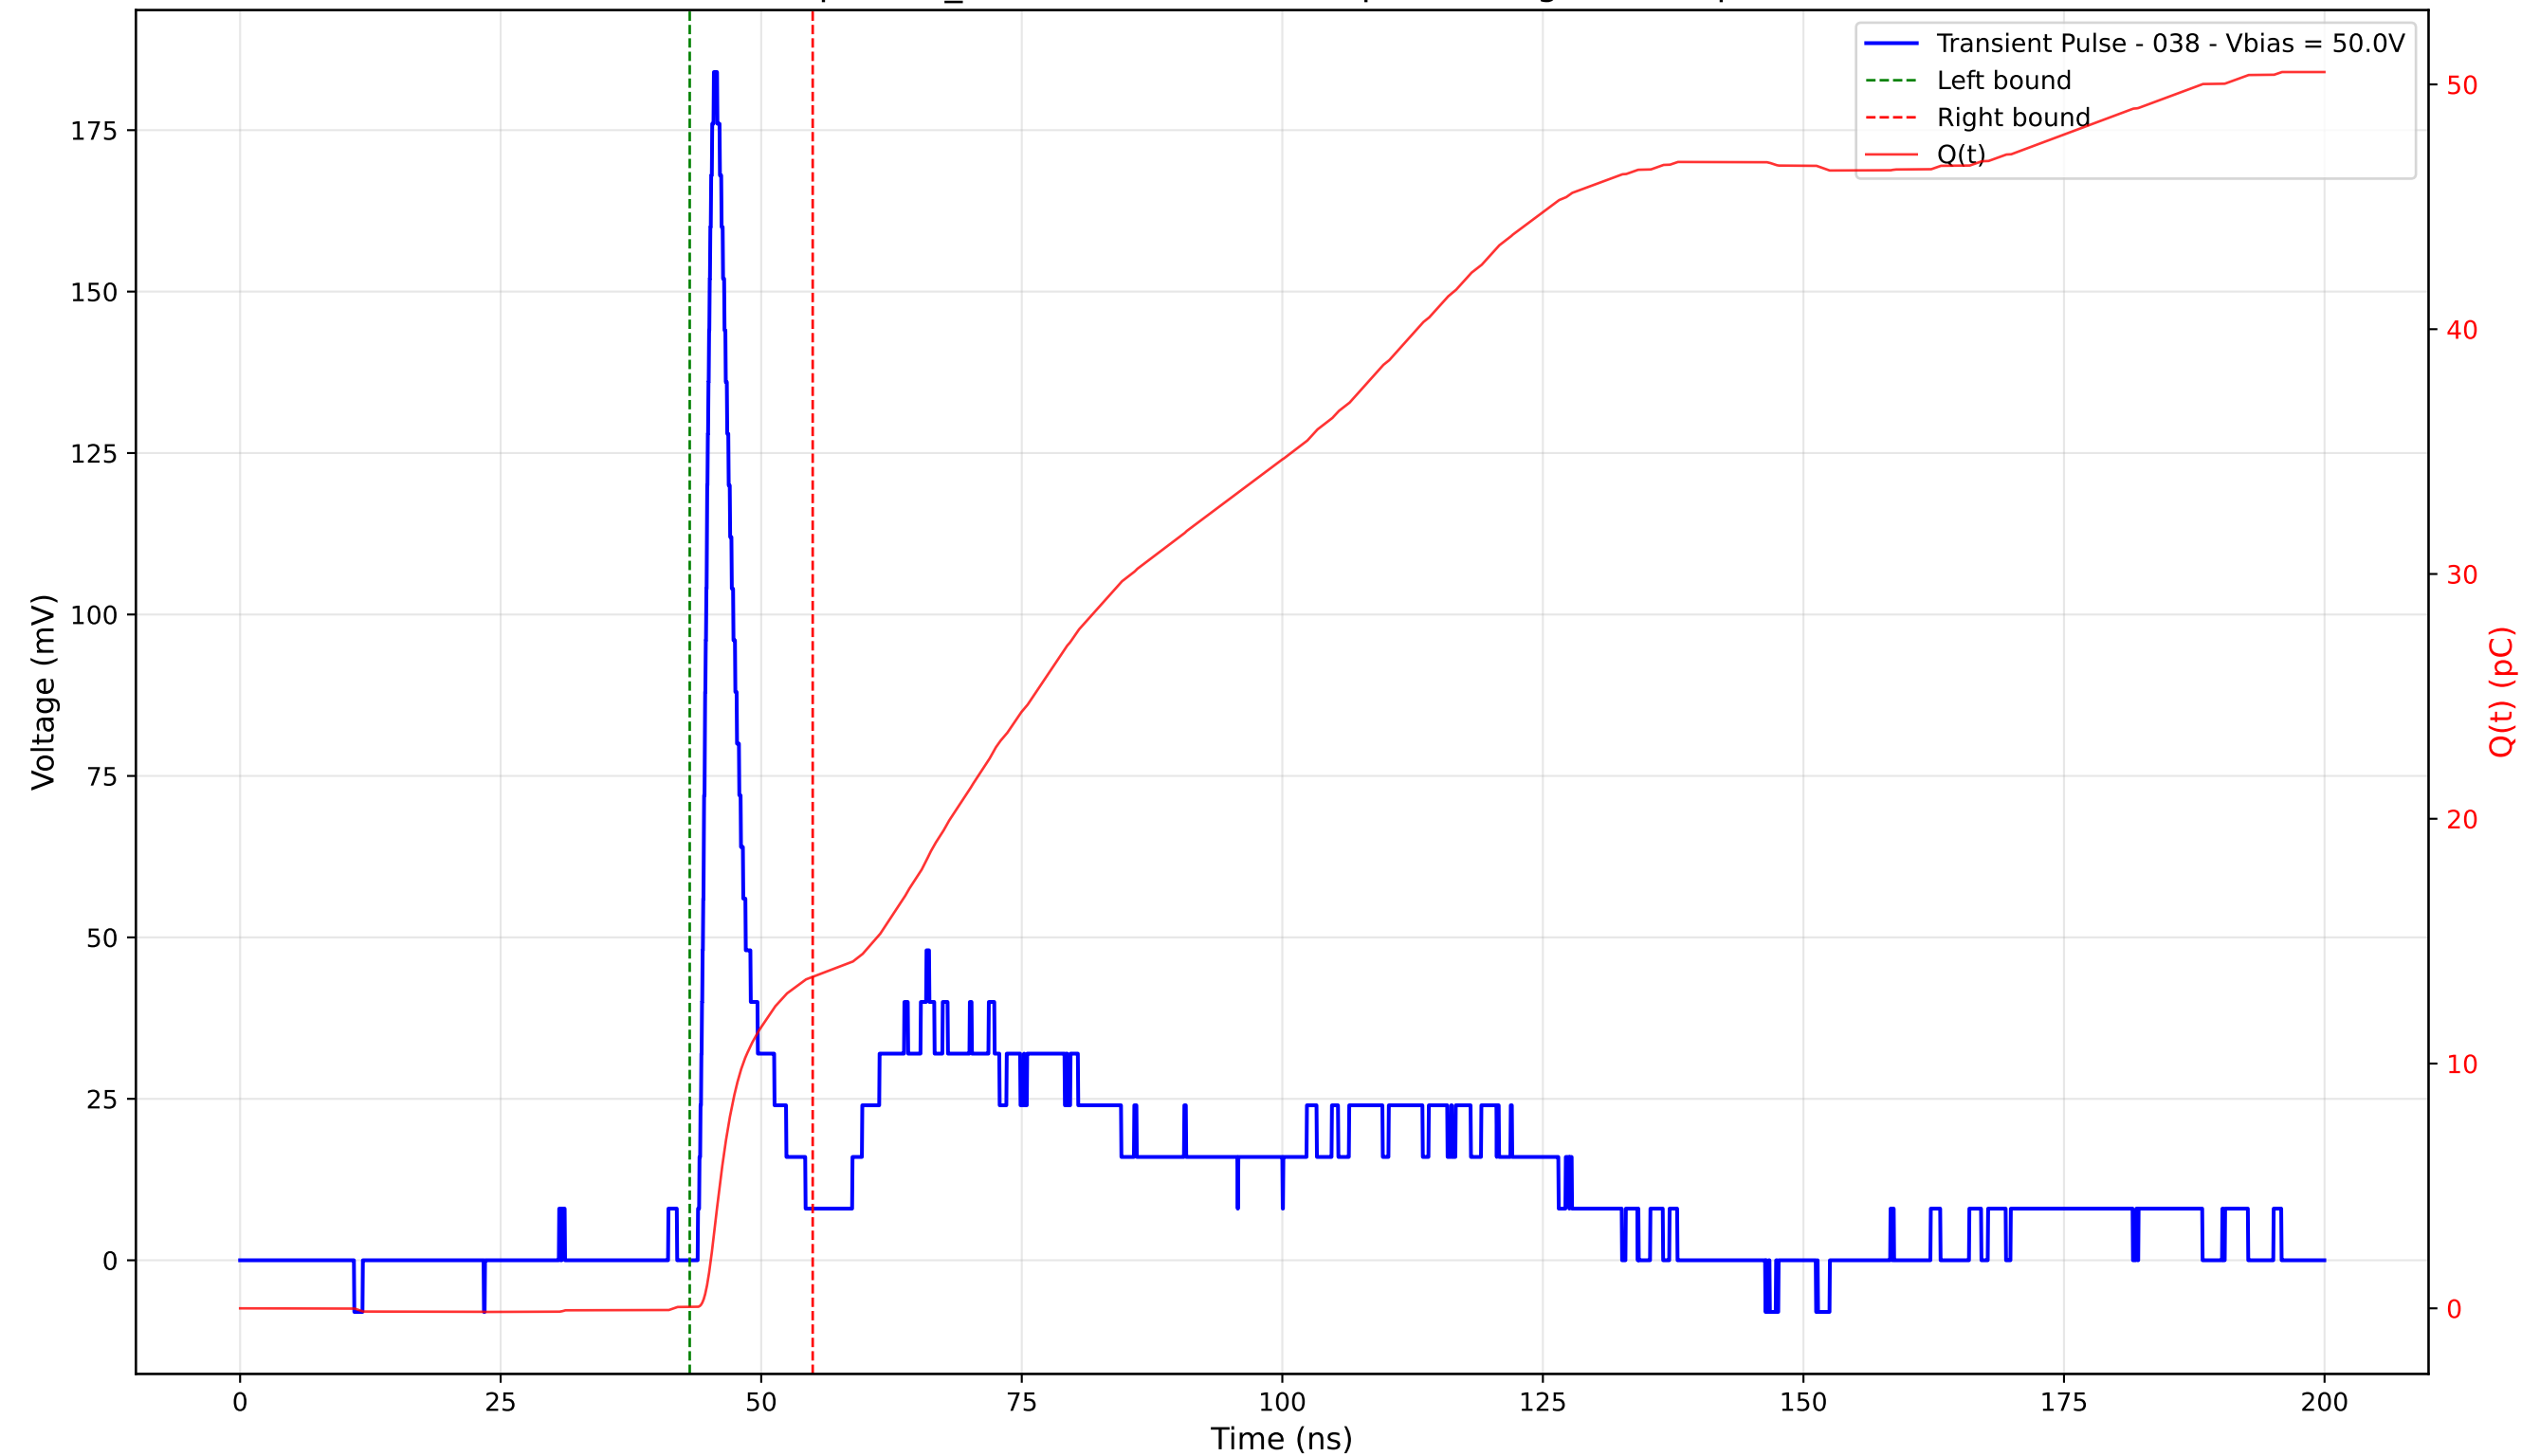


Transient Pulse - Sample: TD_4004 - Position: 305.0 μm - Charge: 53.64 pC - Rise Time: 1.03 ns

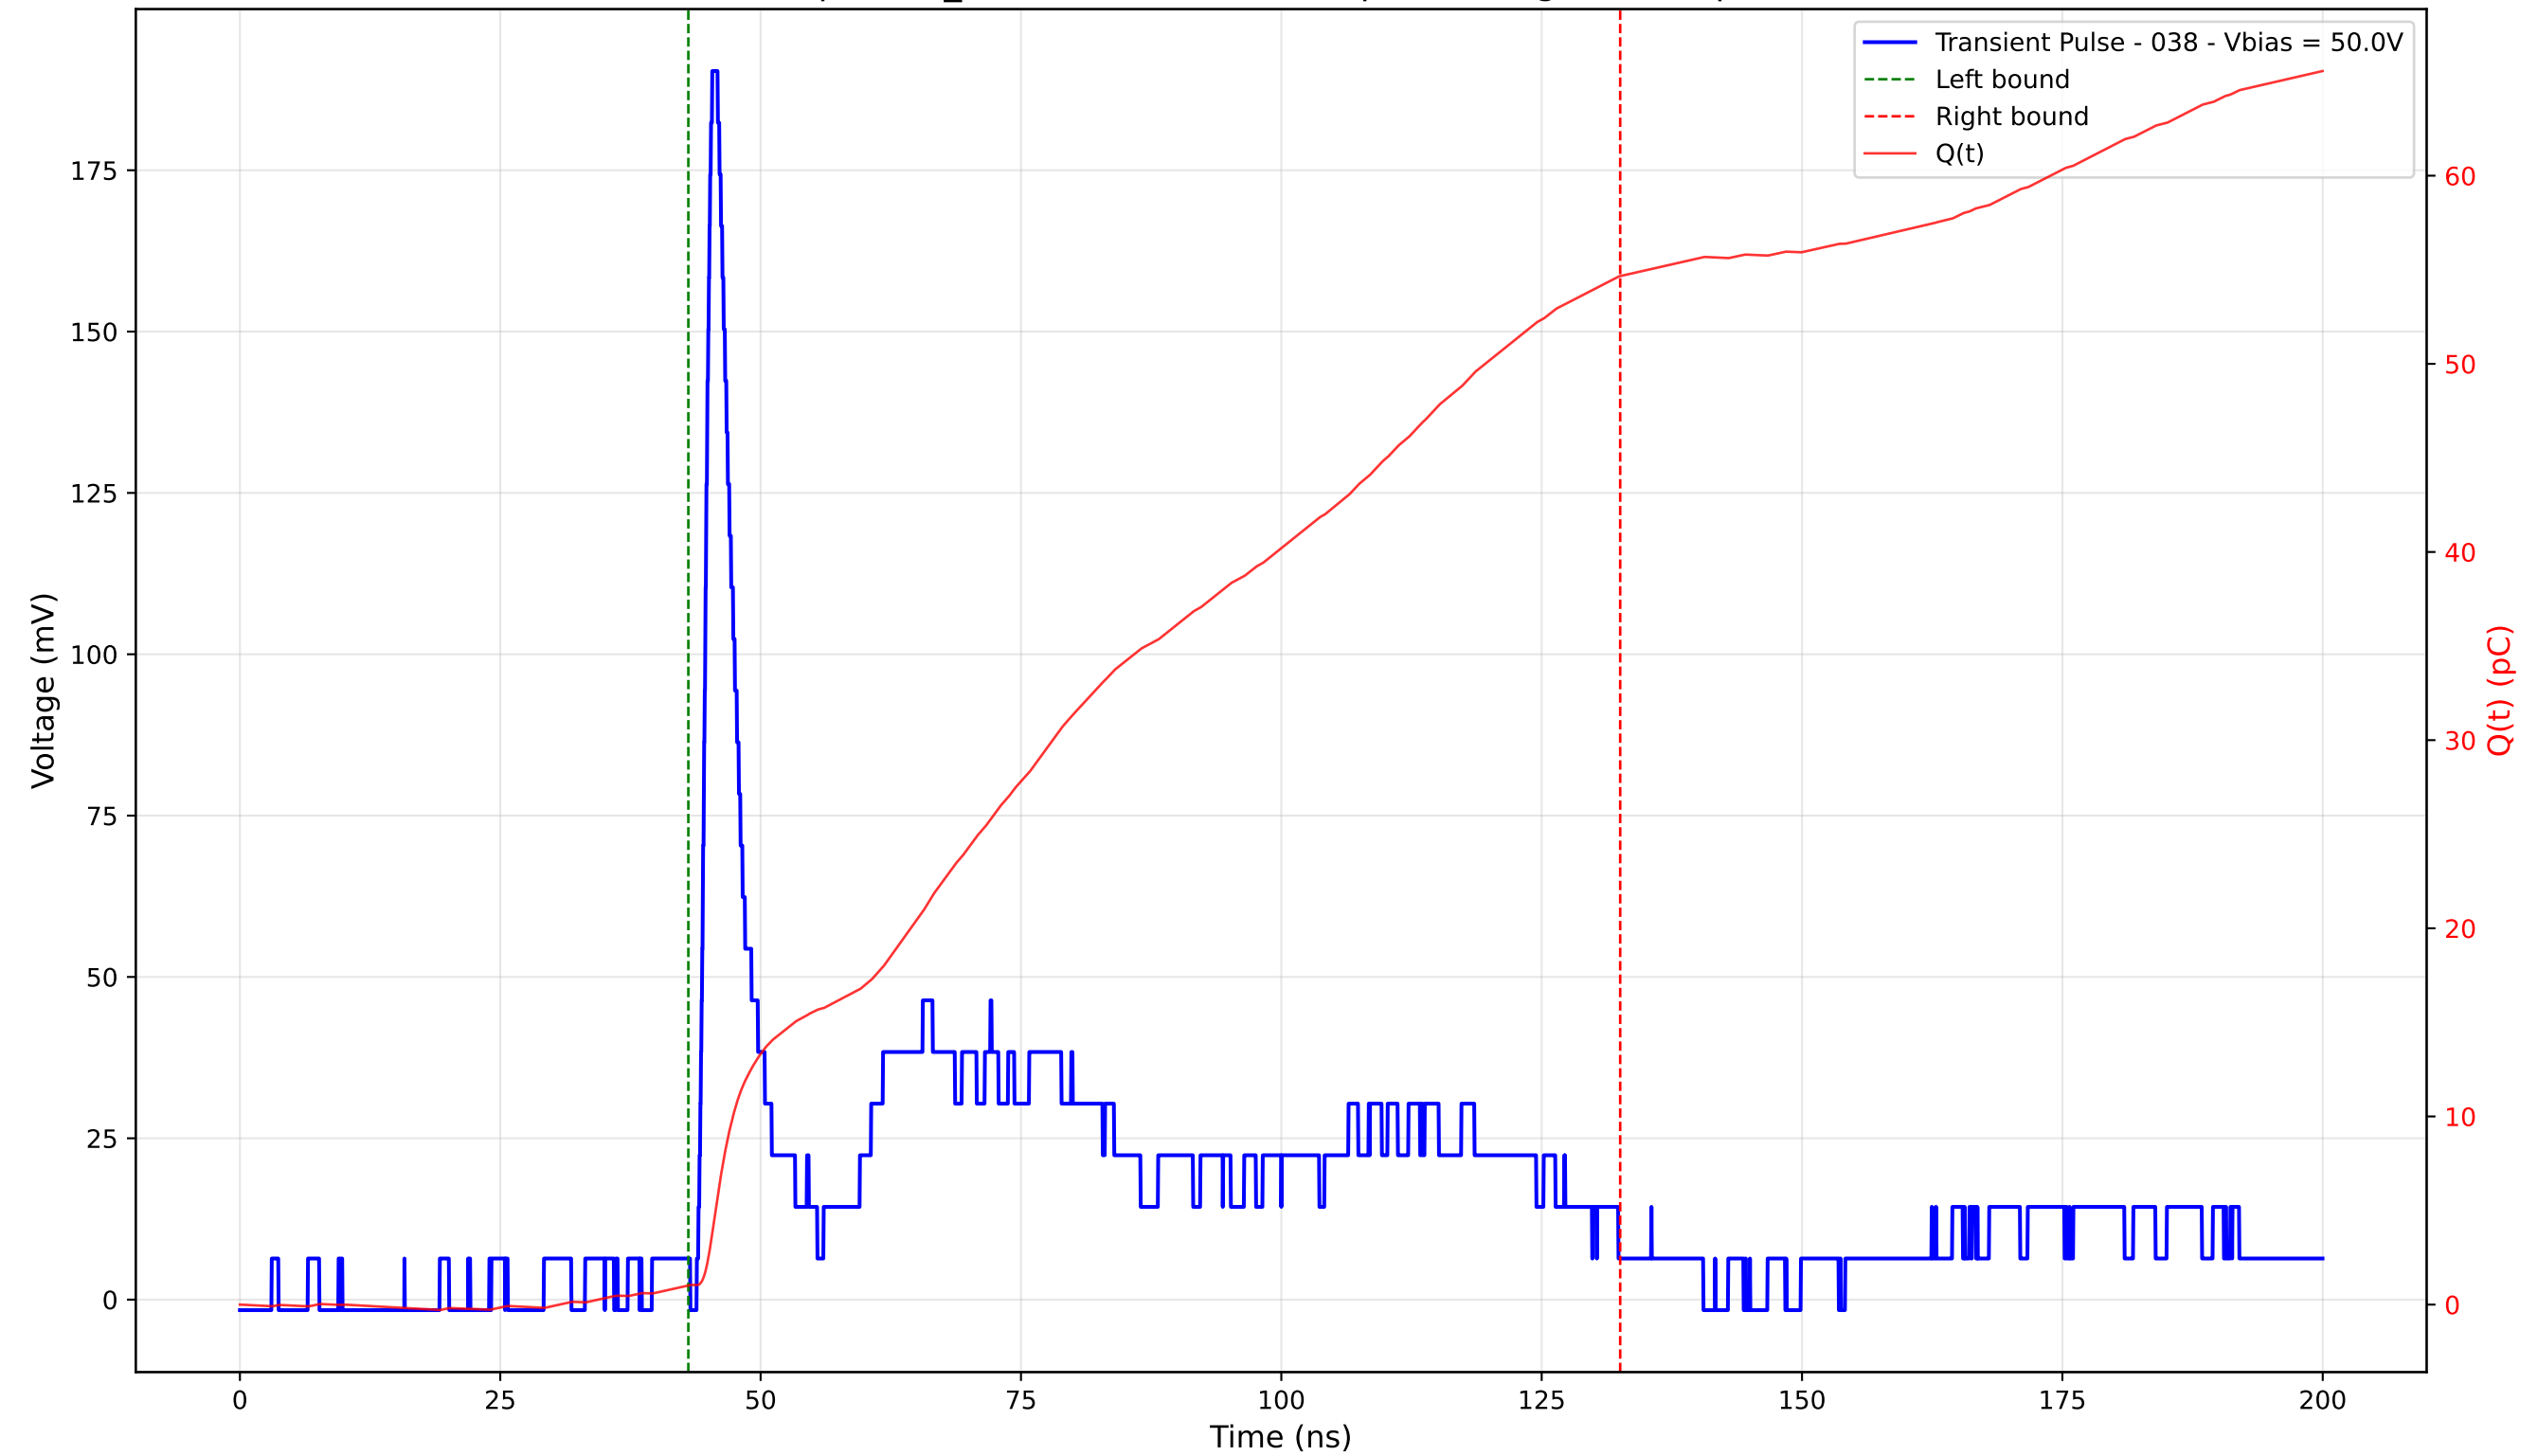


Transient Pulse - Sample: TD_4004 - Position: 310.0 μm - Charge: 13.19 pC - Rise Time: 1.06 ns

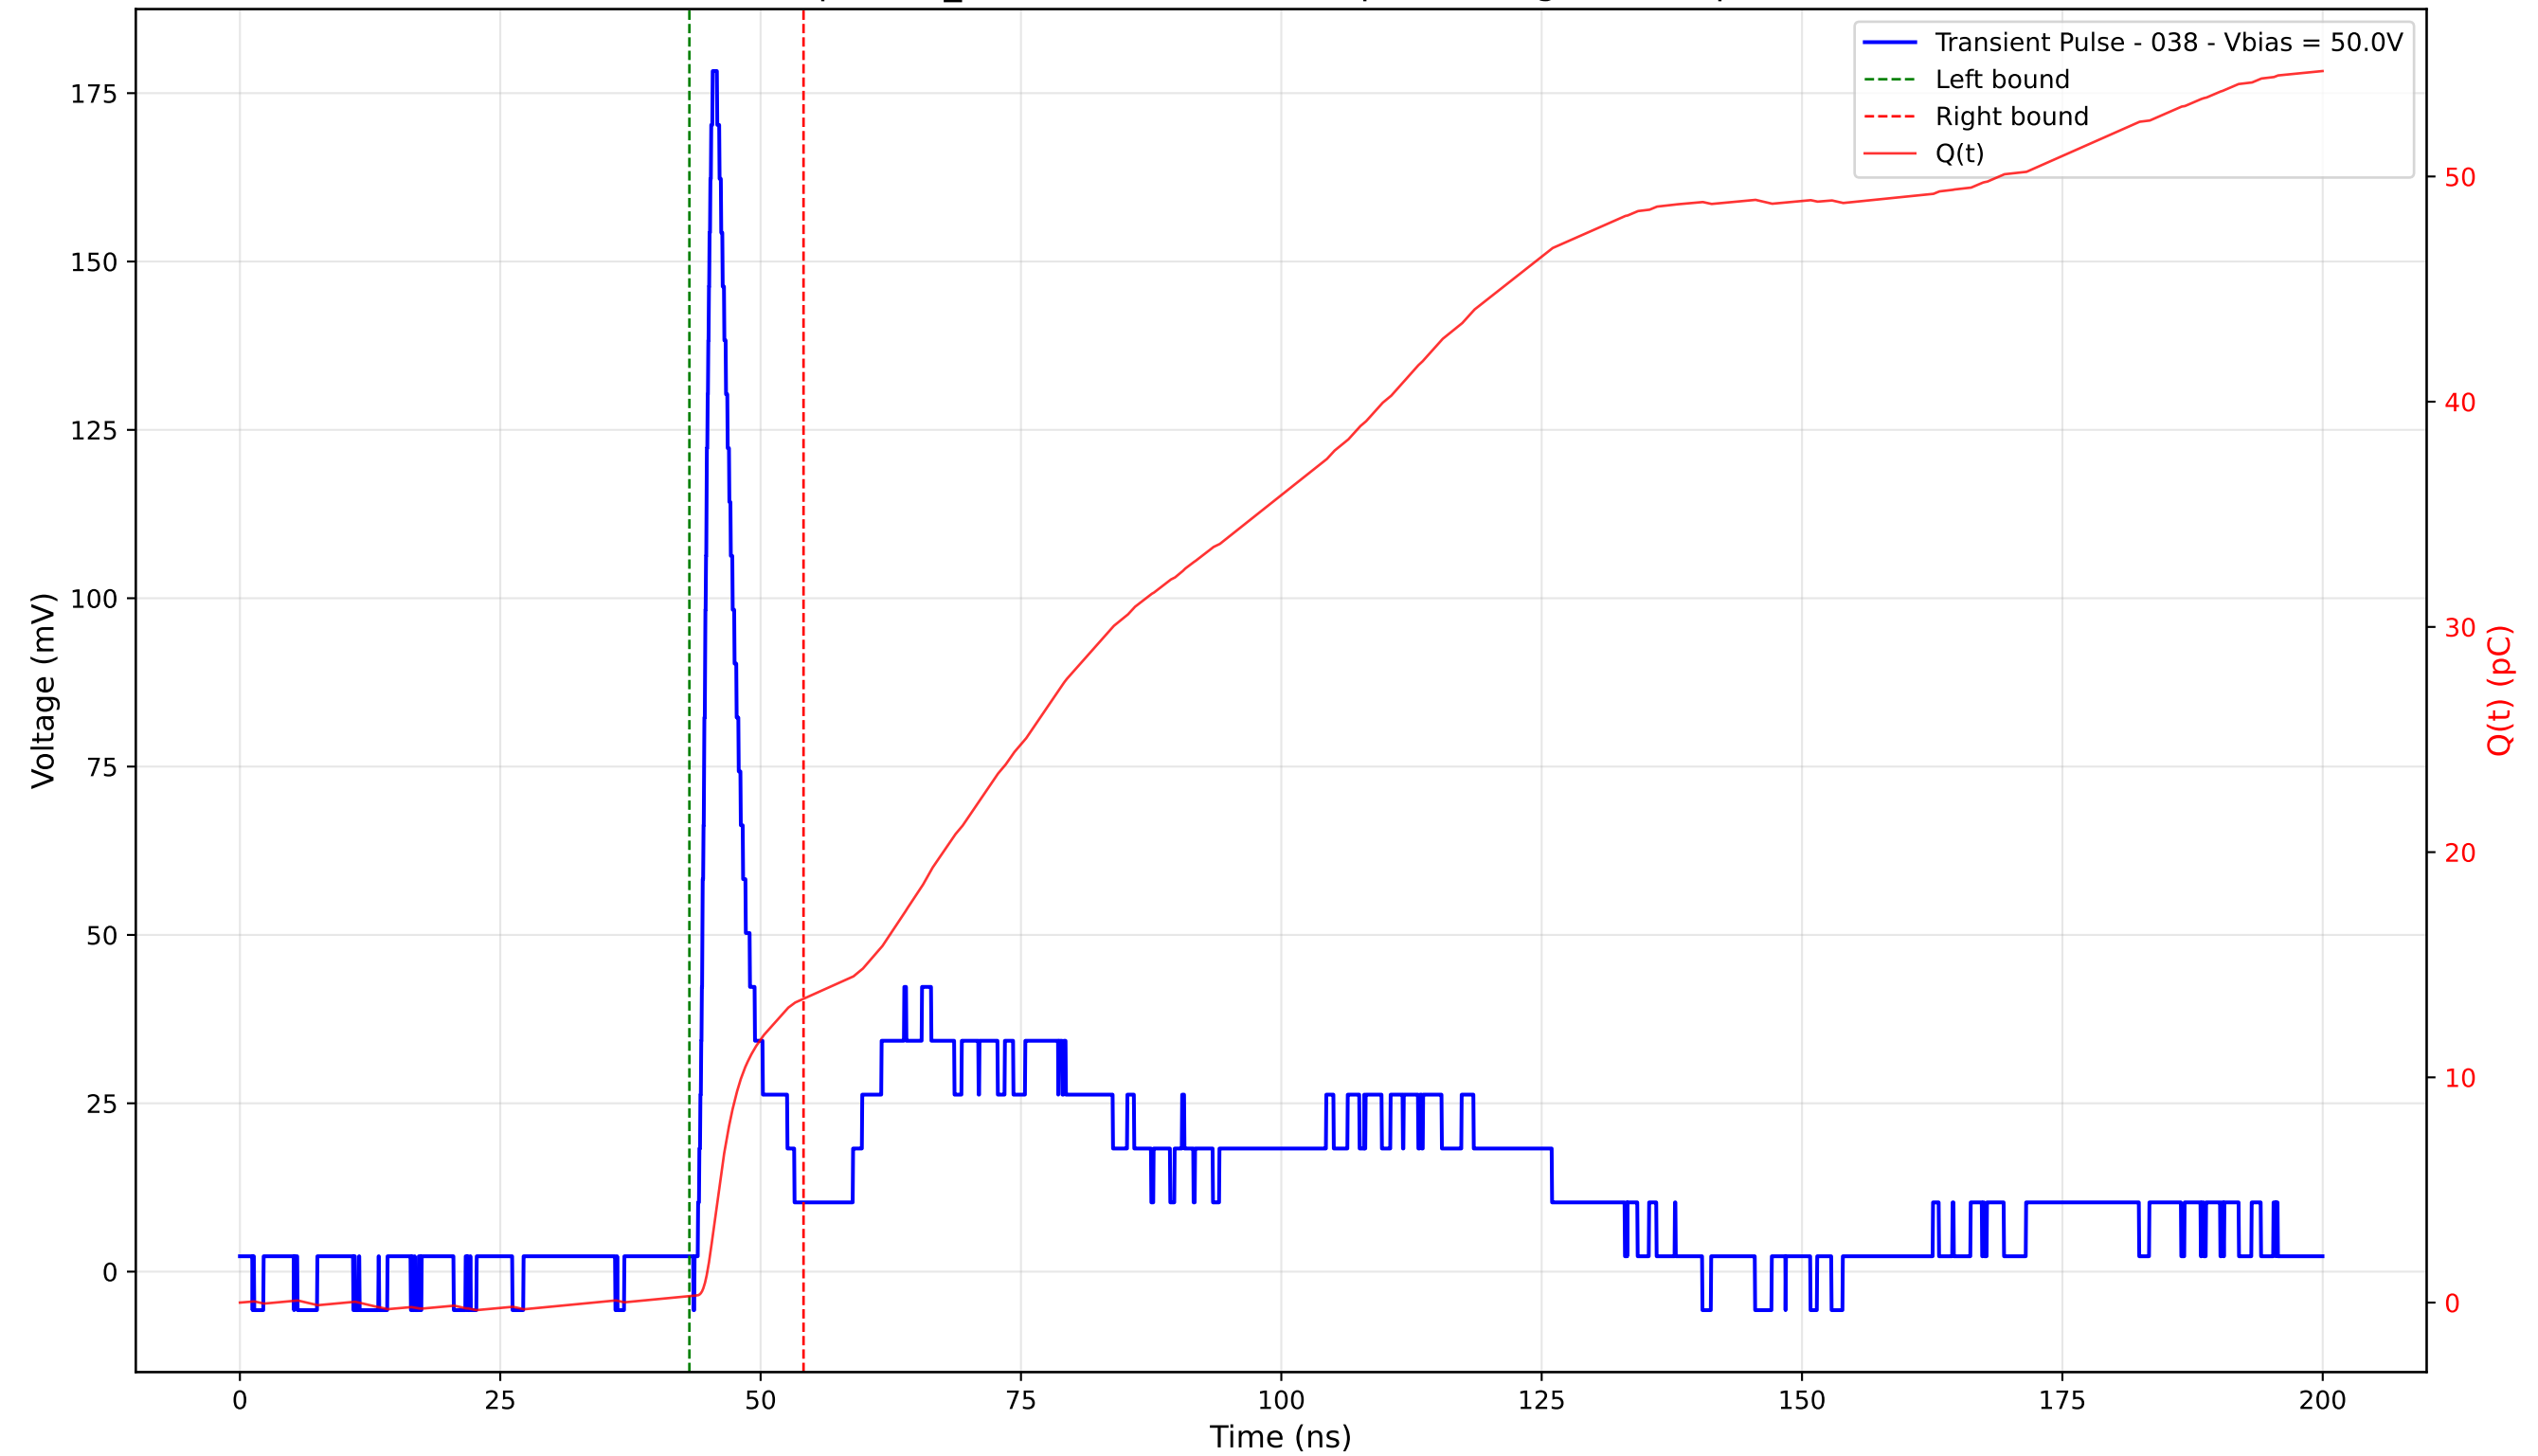


Transient Pulse - Sample: TD_4004 - Position: 315.0 μm - Charge: 49.05 pC - Rise Time: 1.05 ns

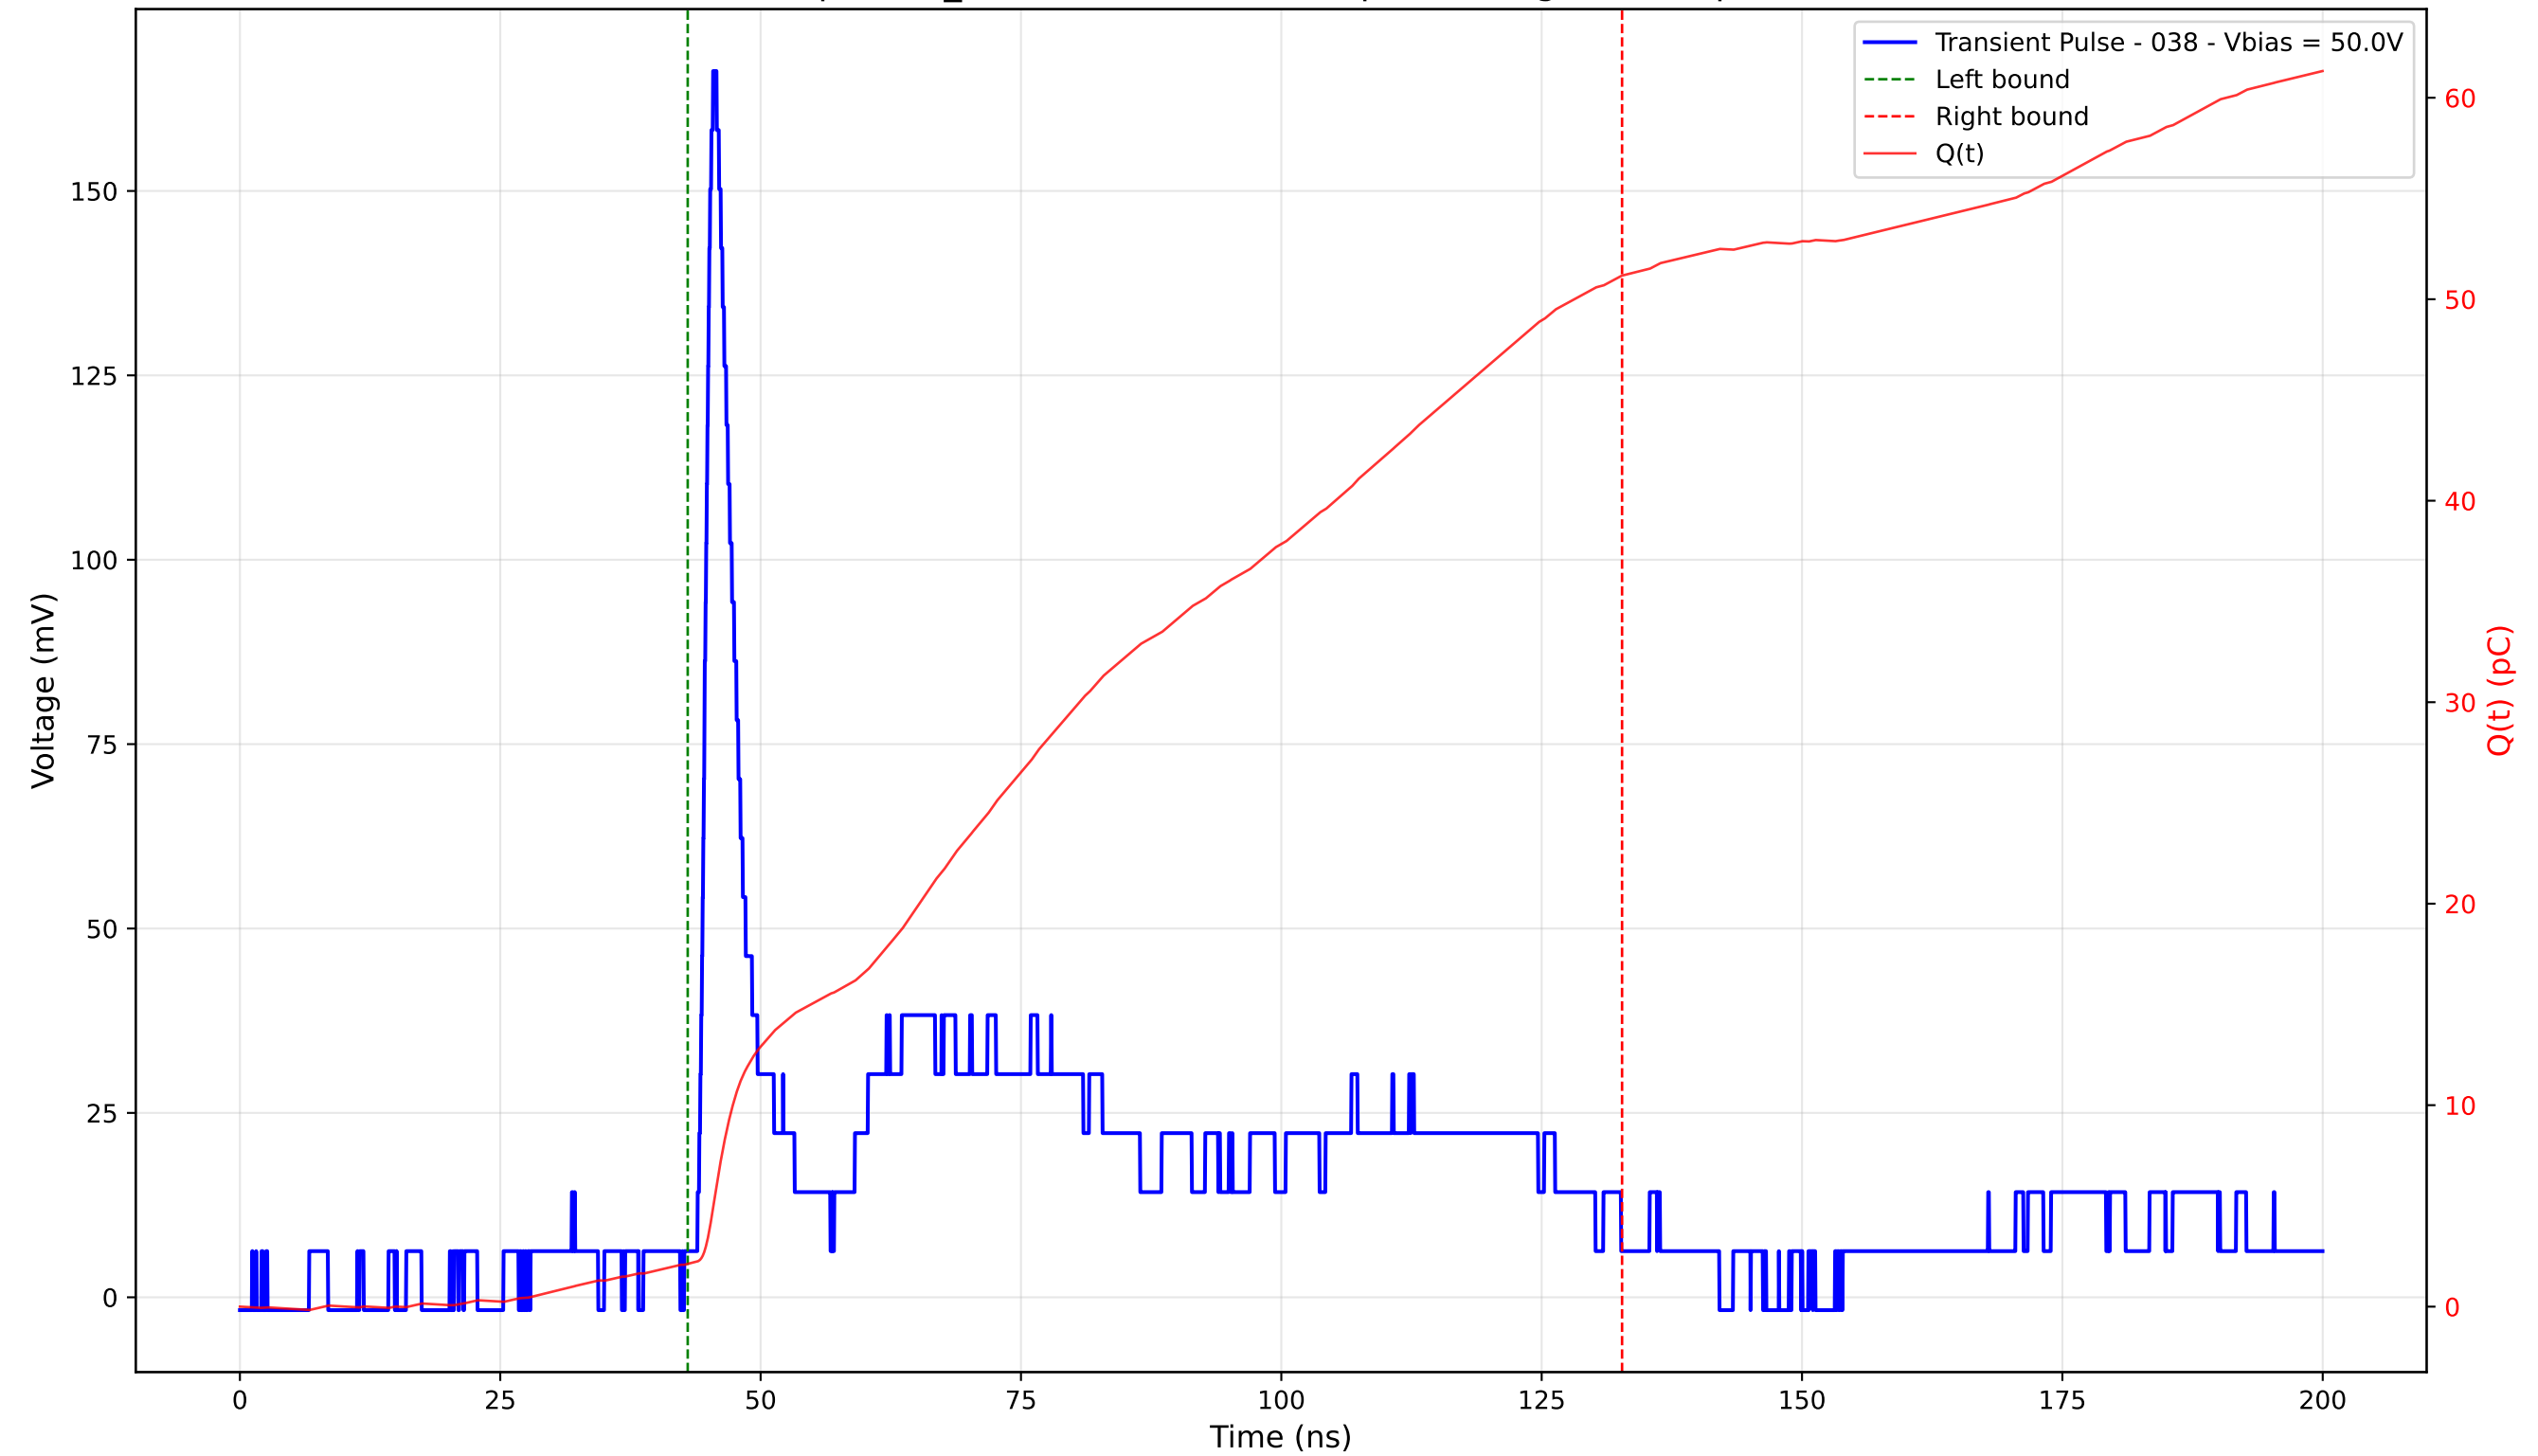


Transient Pulse - Sample: TD_4004 - Position: 320.0 μm - Charge: 11.86 pC - Rise Time: 1.05 ns

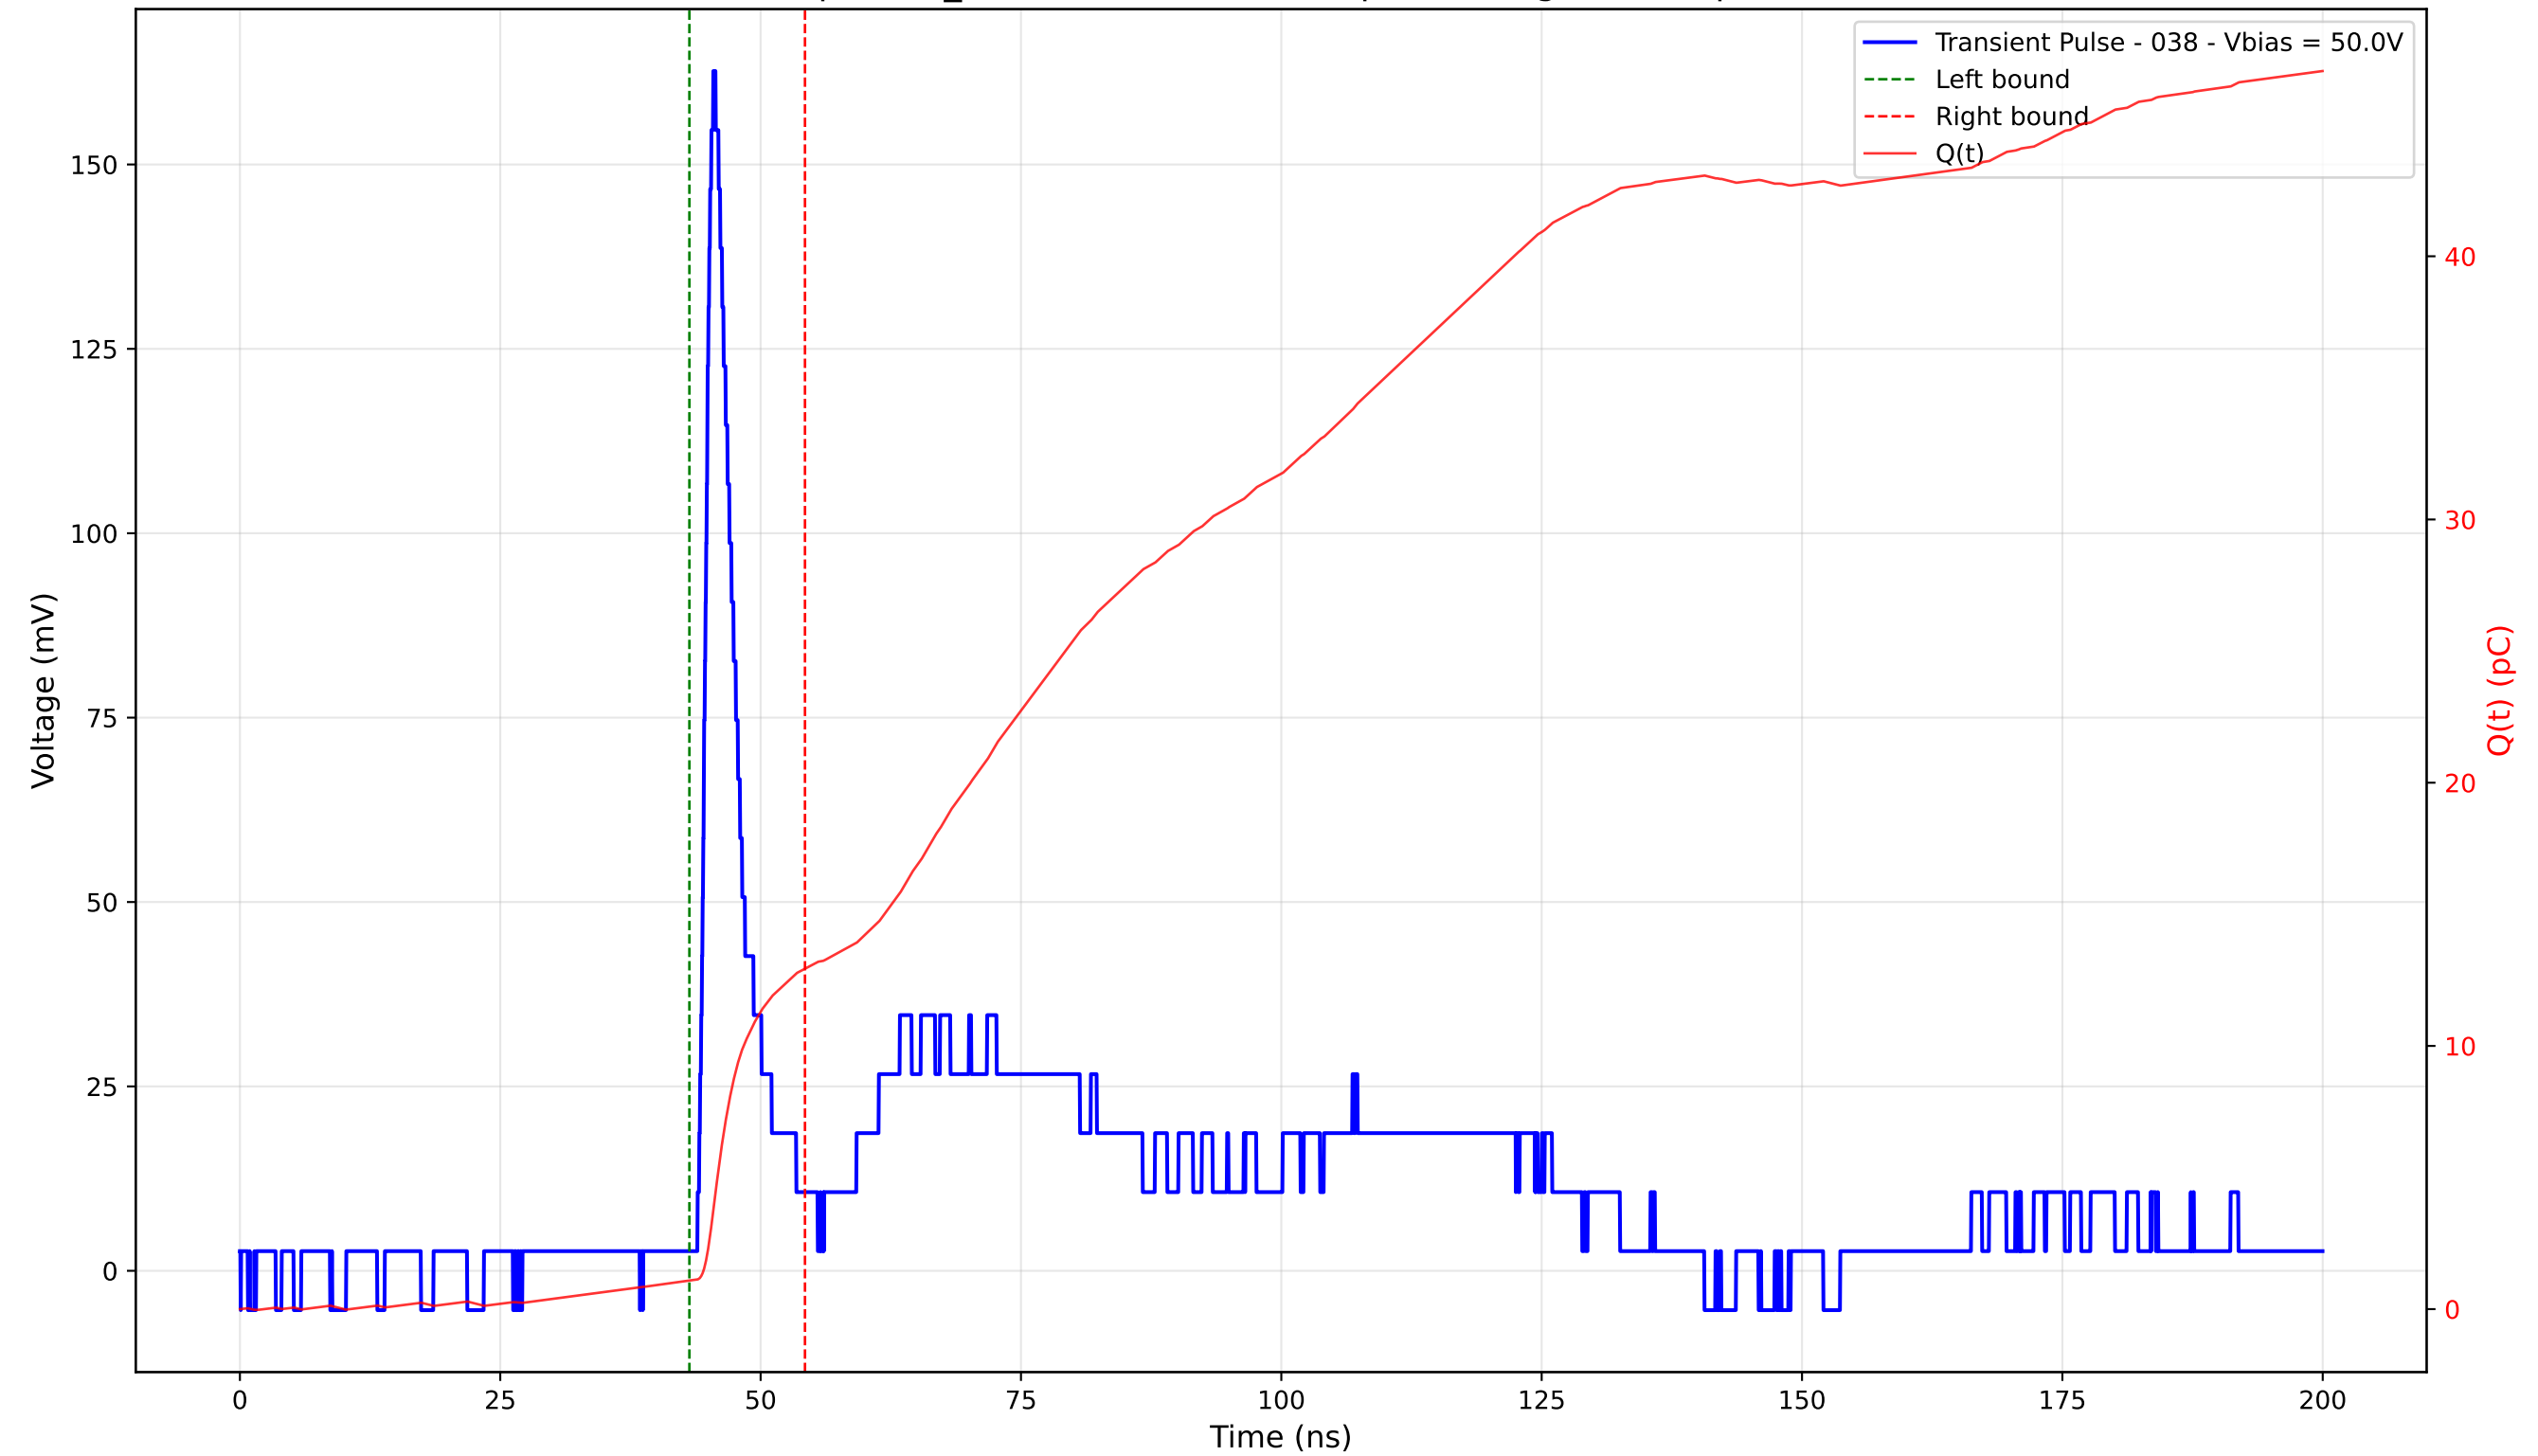


Transient Pulse - Sample: TD_4004 - Position: 325.0 μm - Charge: 11.53 pC - Rise Time: 1.05 ns

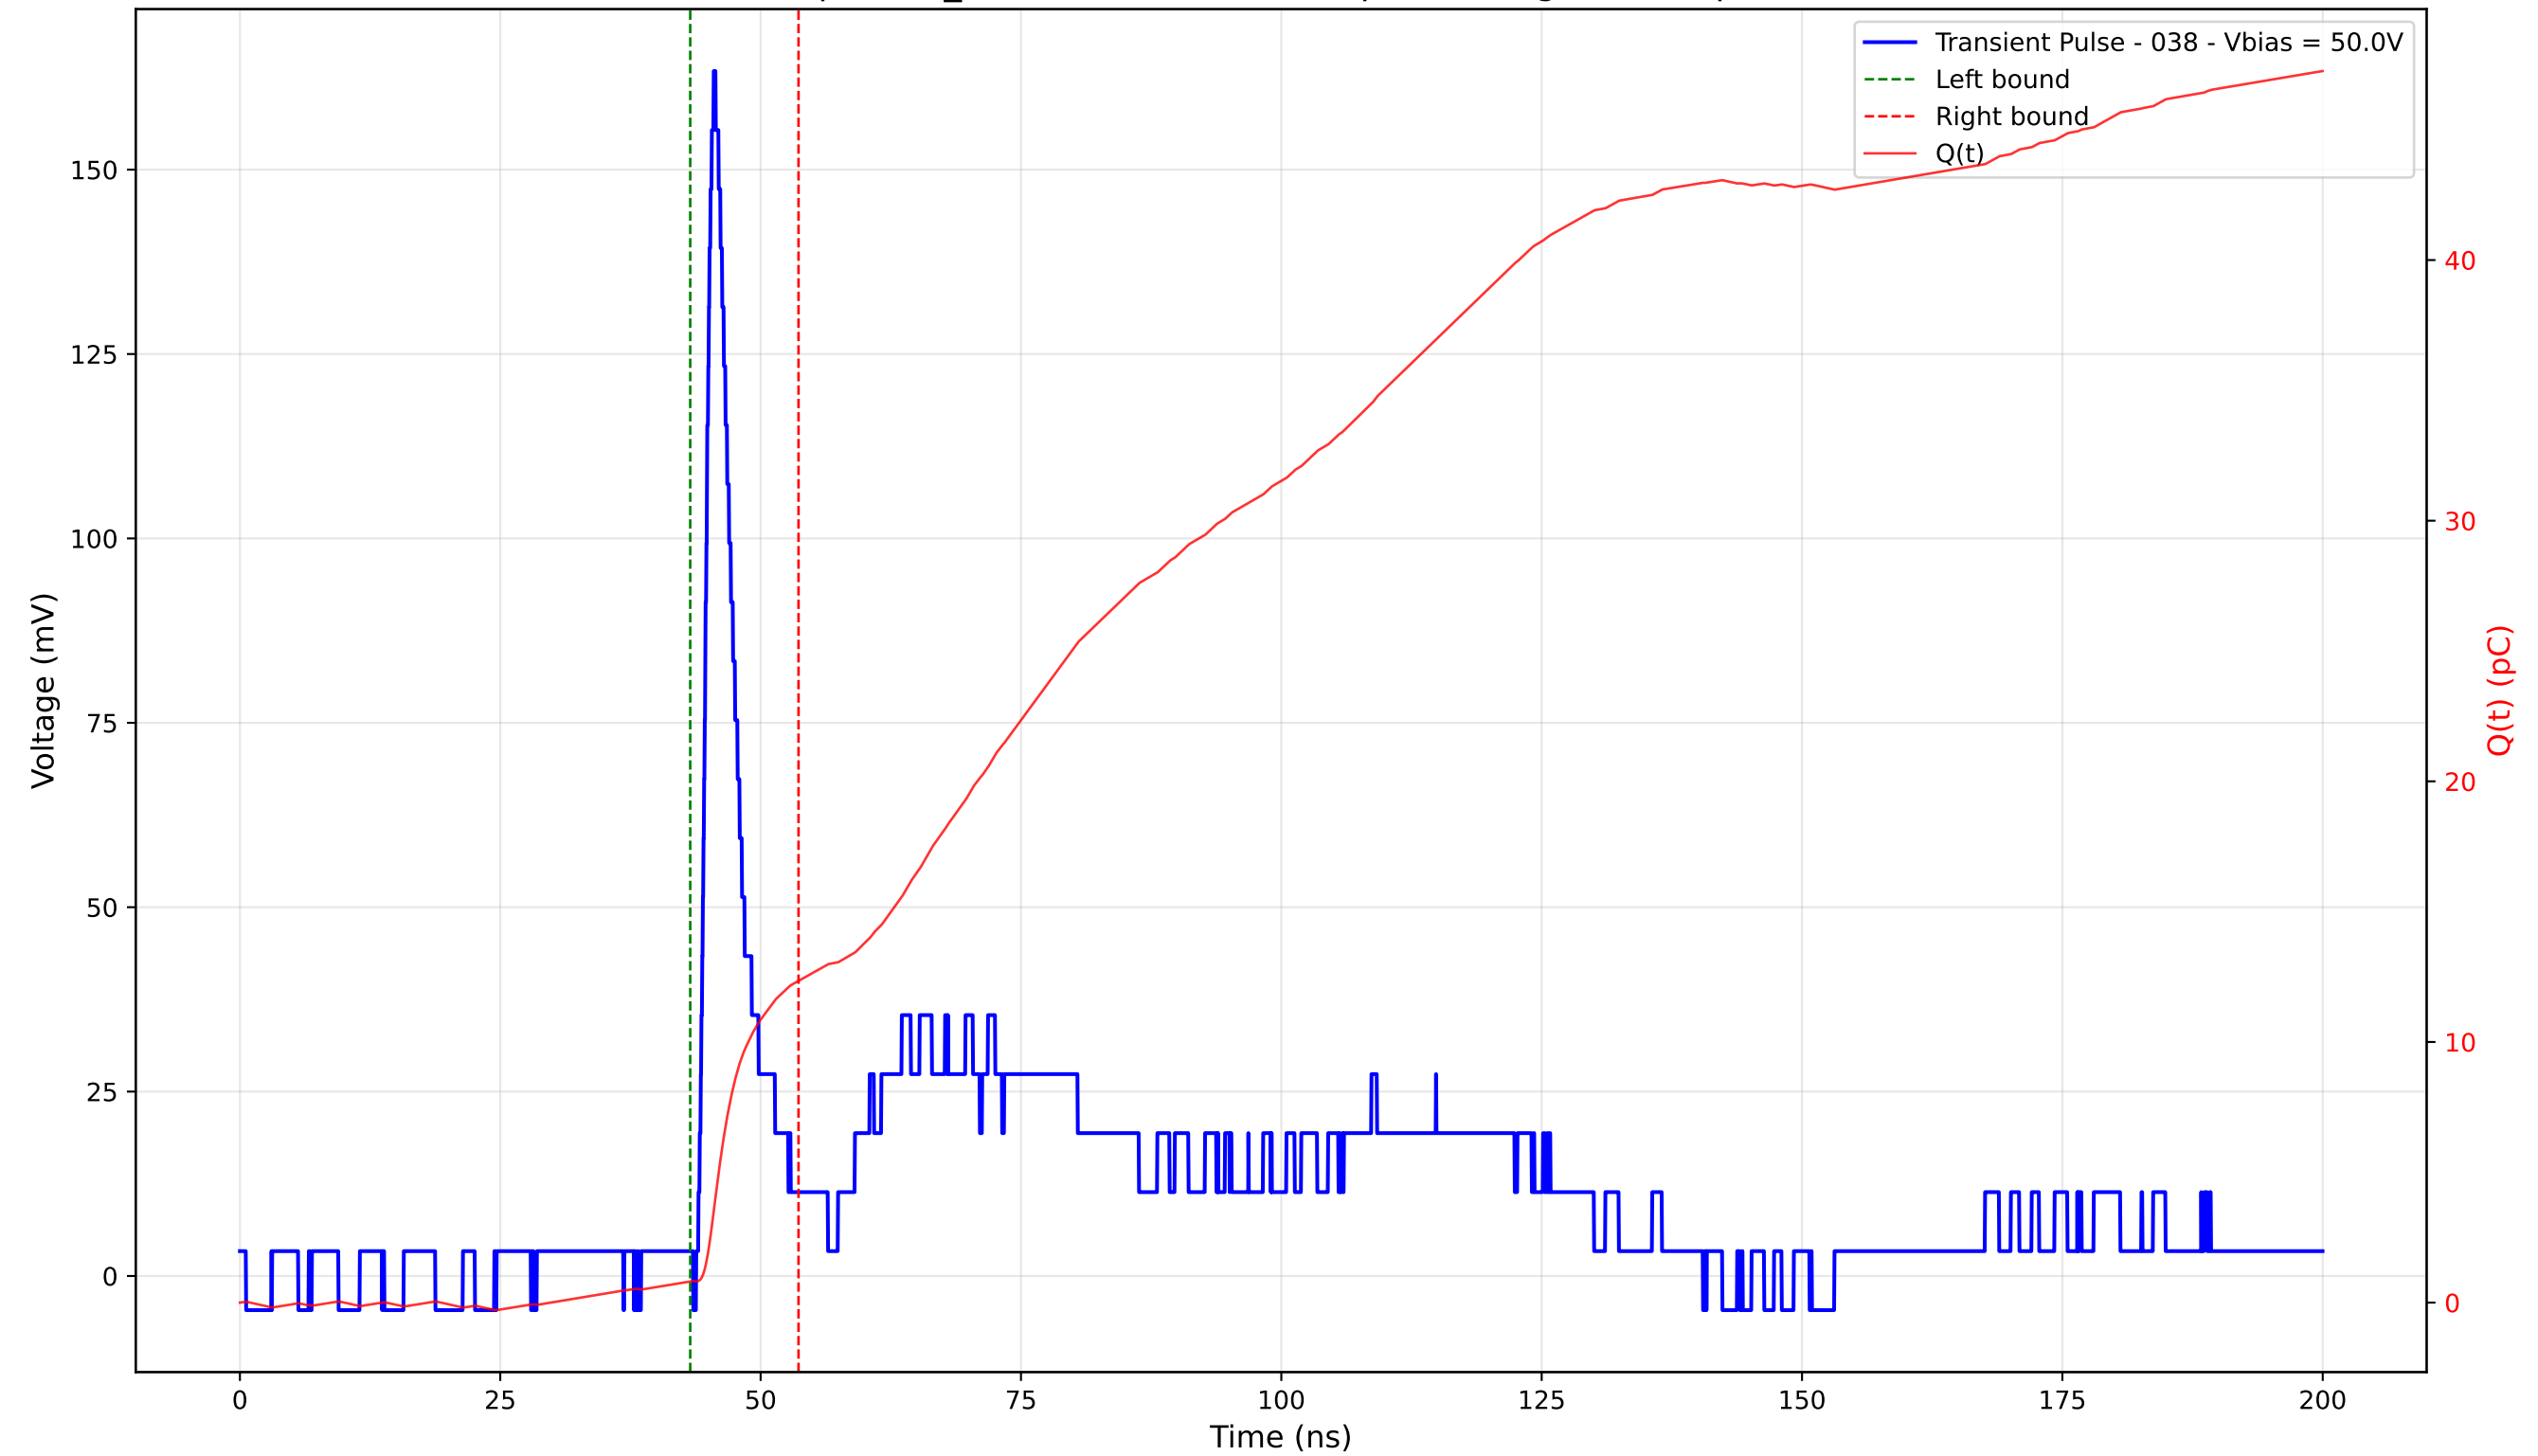


Transient Pulse - Sample: TD_4004 - Position: 330.0 μm - Charge: 10.79 pC - Rise Time: 1.13 ns

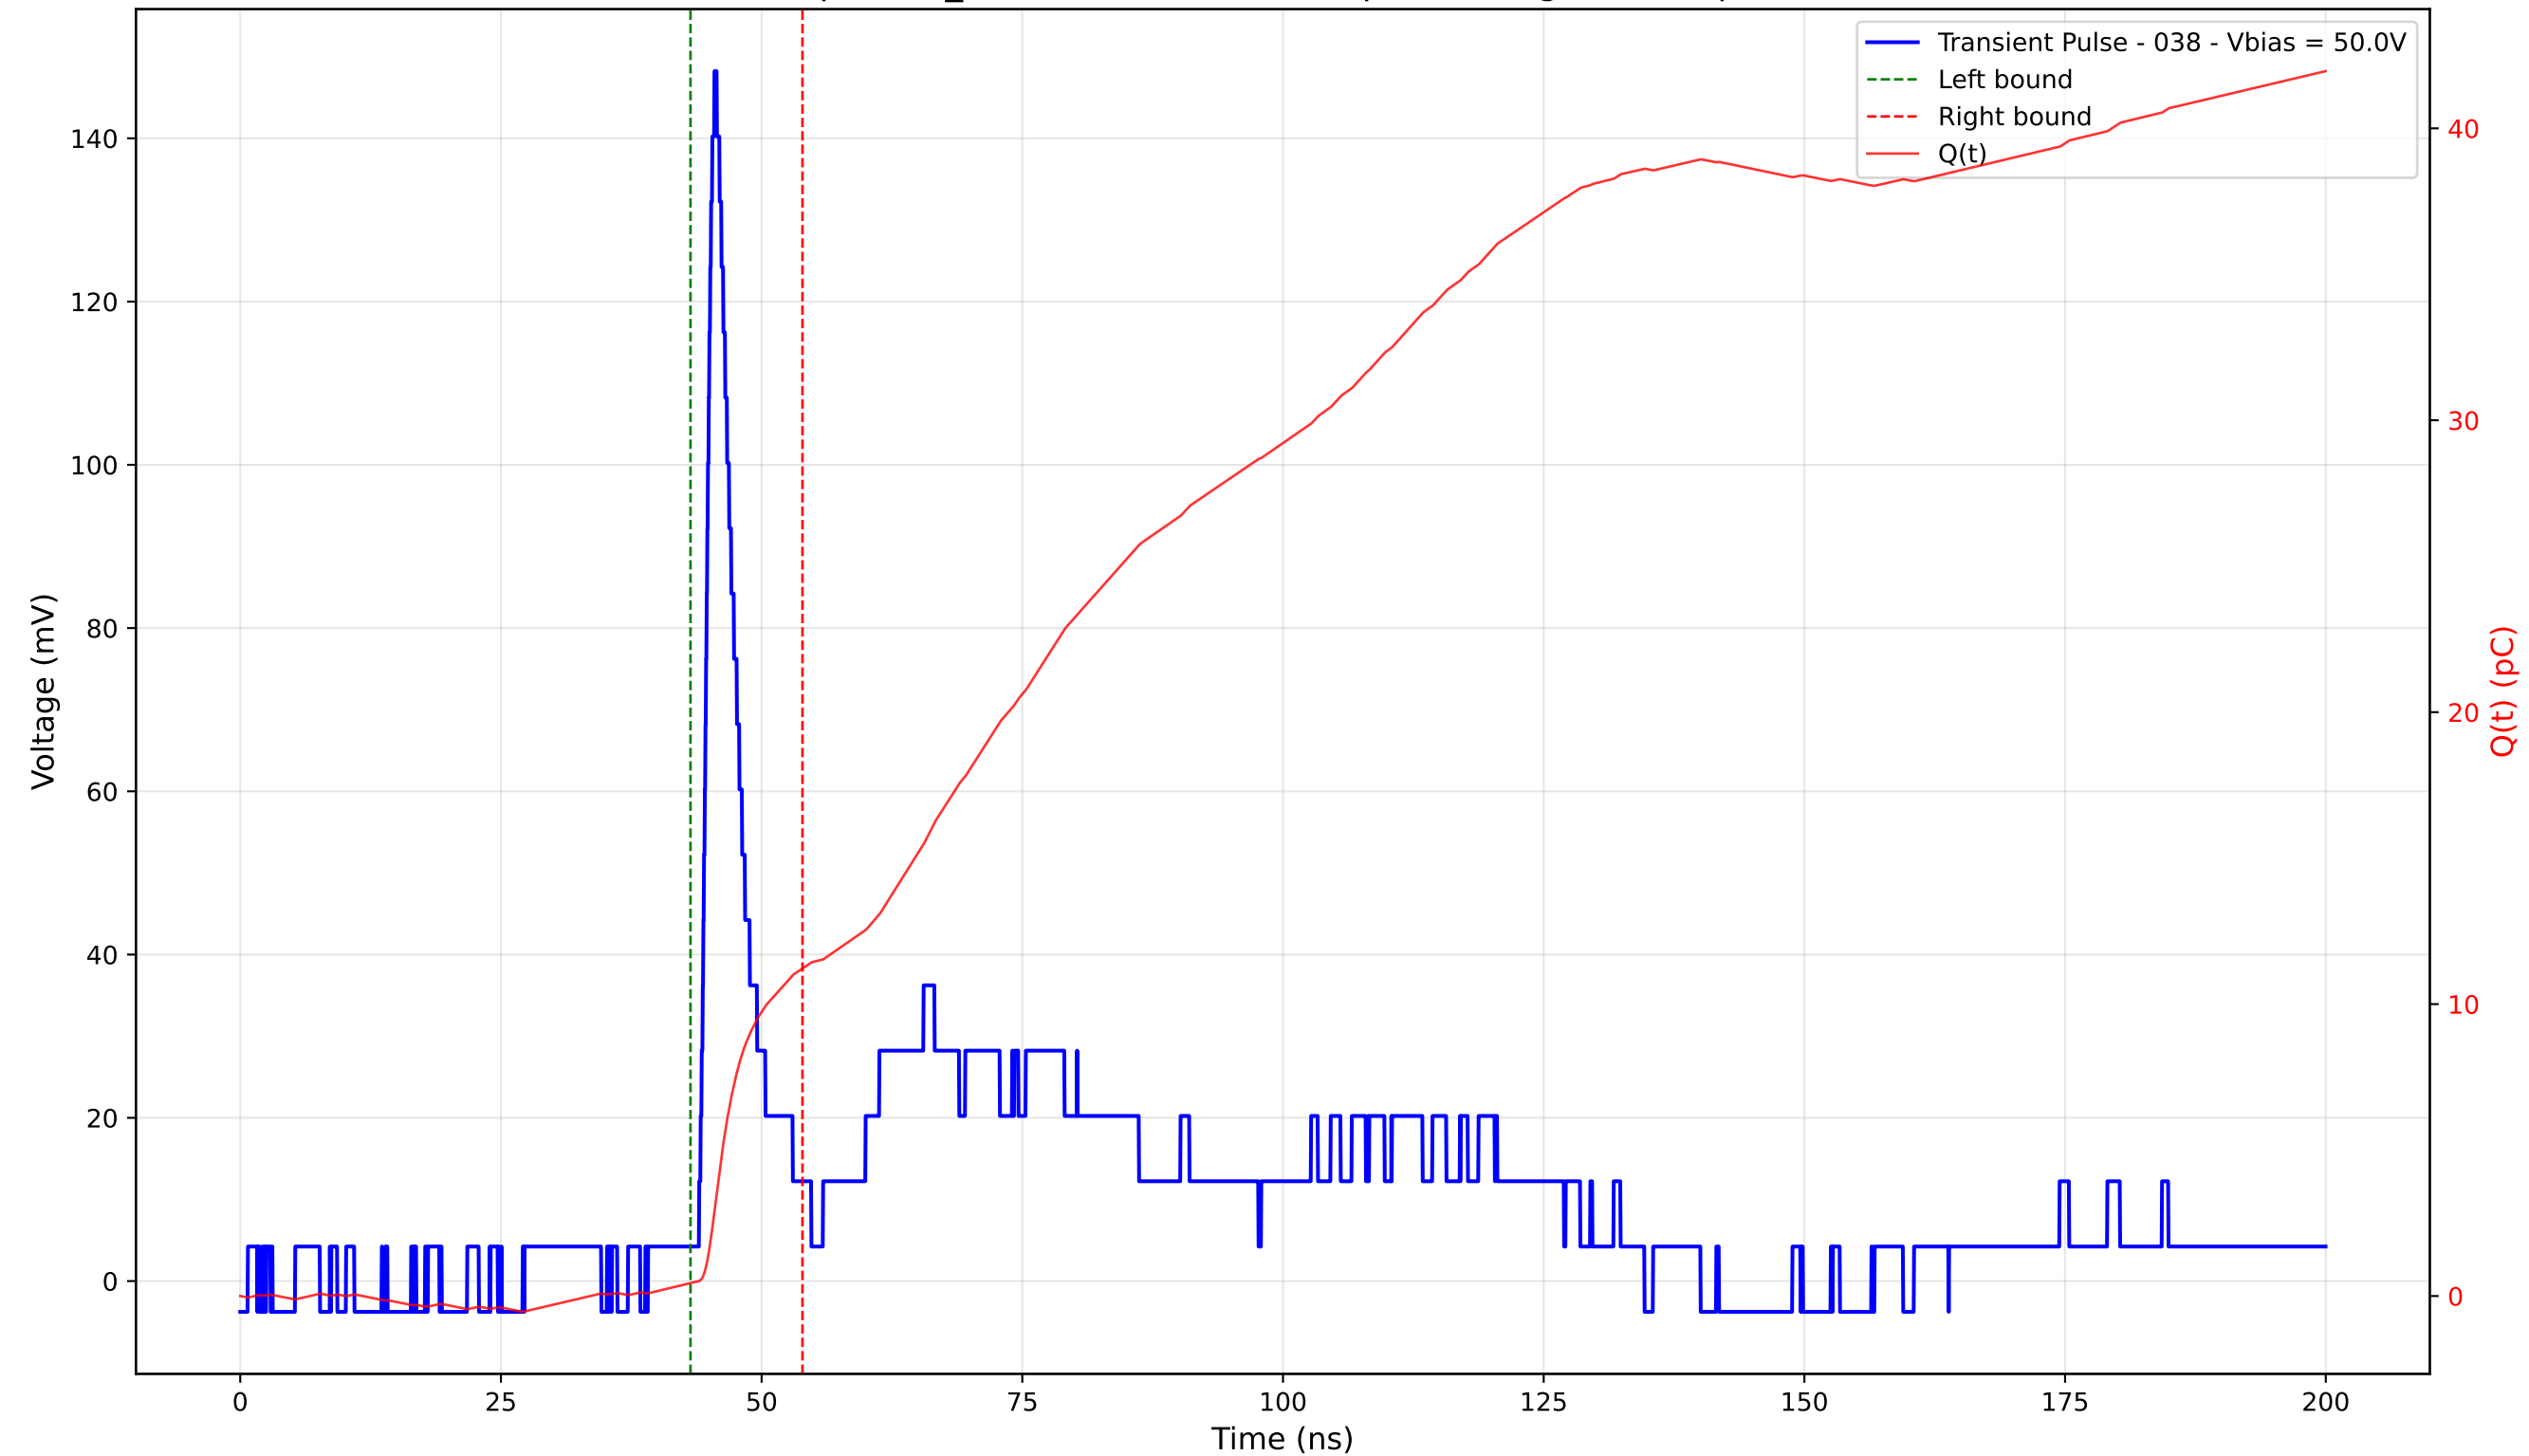


Transient Pulse - Sample: TD_4004 - Position: 335.0 μm - Charge: 32.14 pC - Rise Time: 1.01 ns

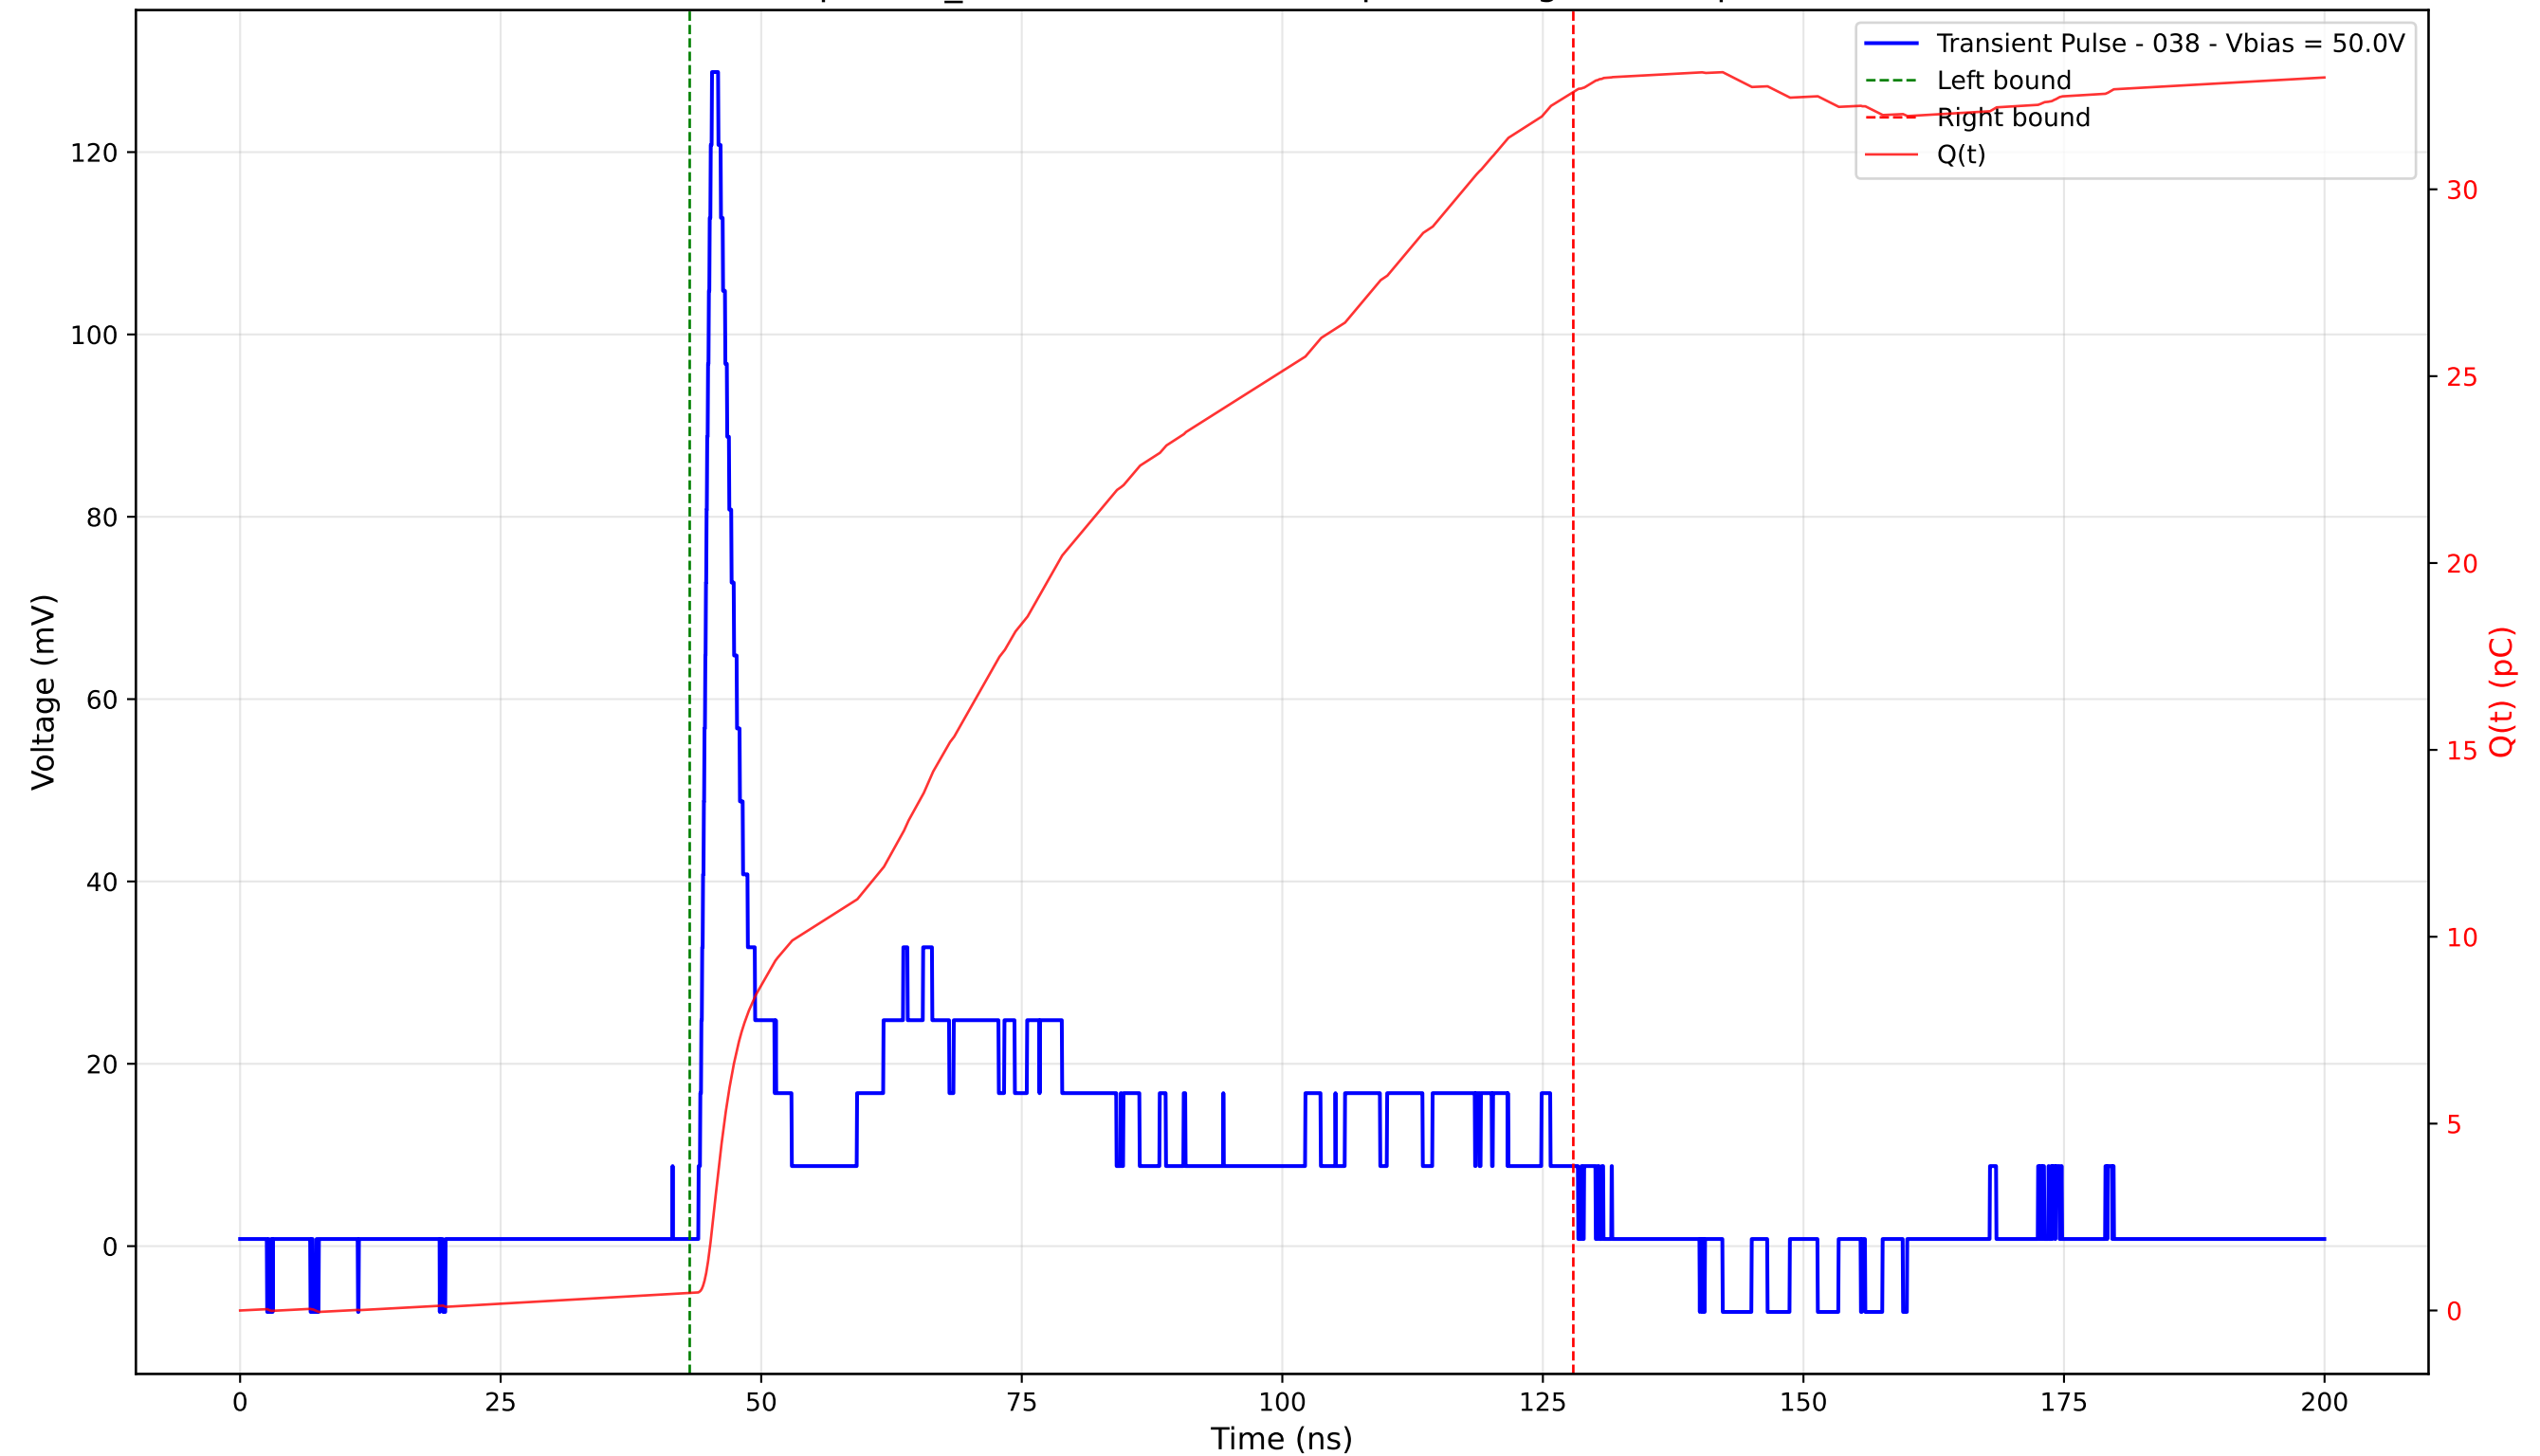


Transient Pulse - Sample: TD_4004 - Position: 340.0 μm - Charge: 9.91 pC - Rise Time: 1.11 ns

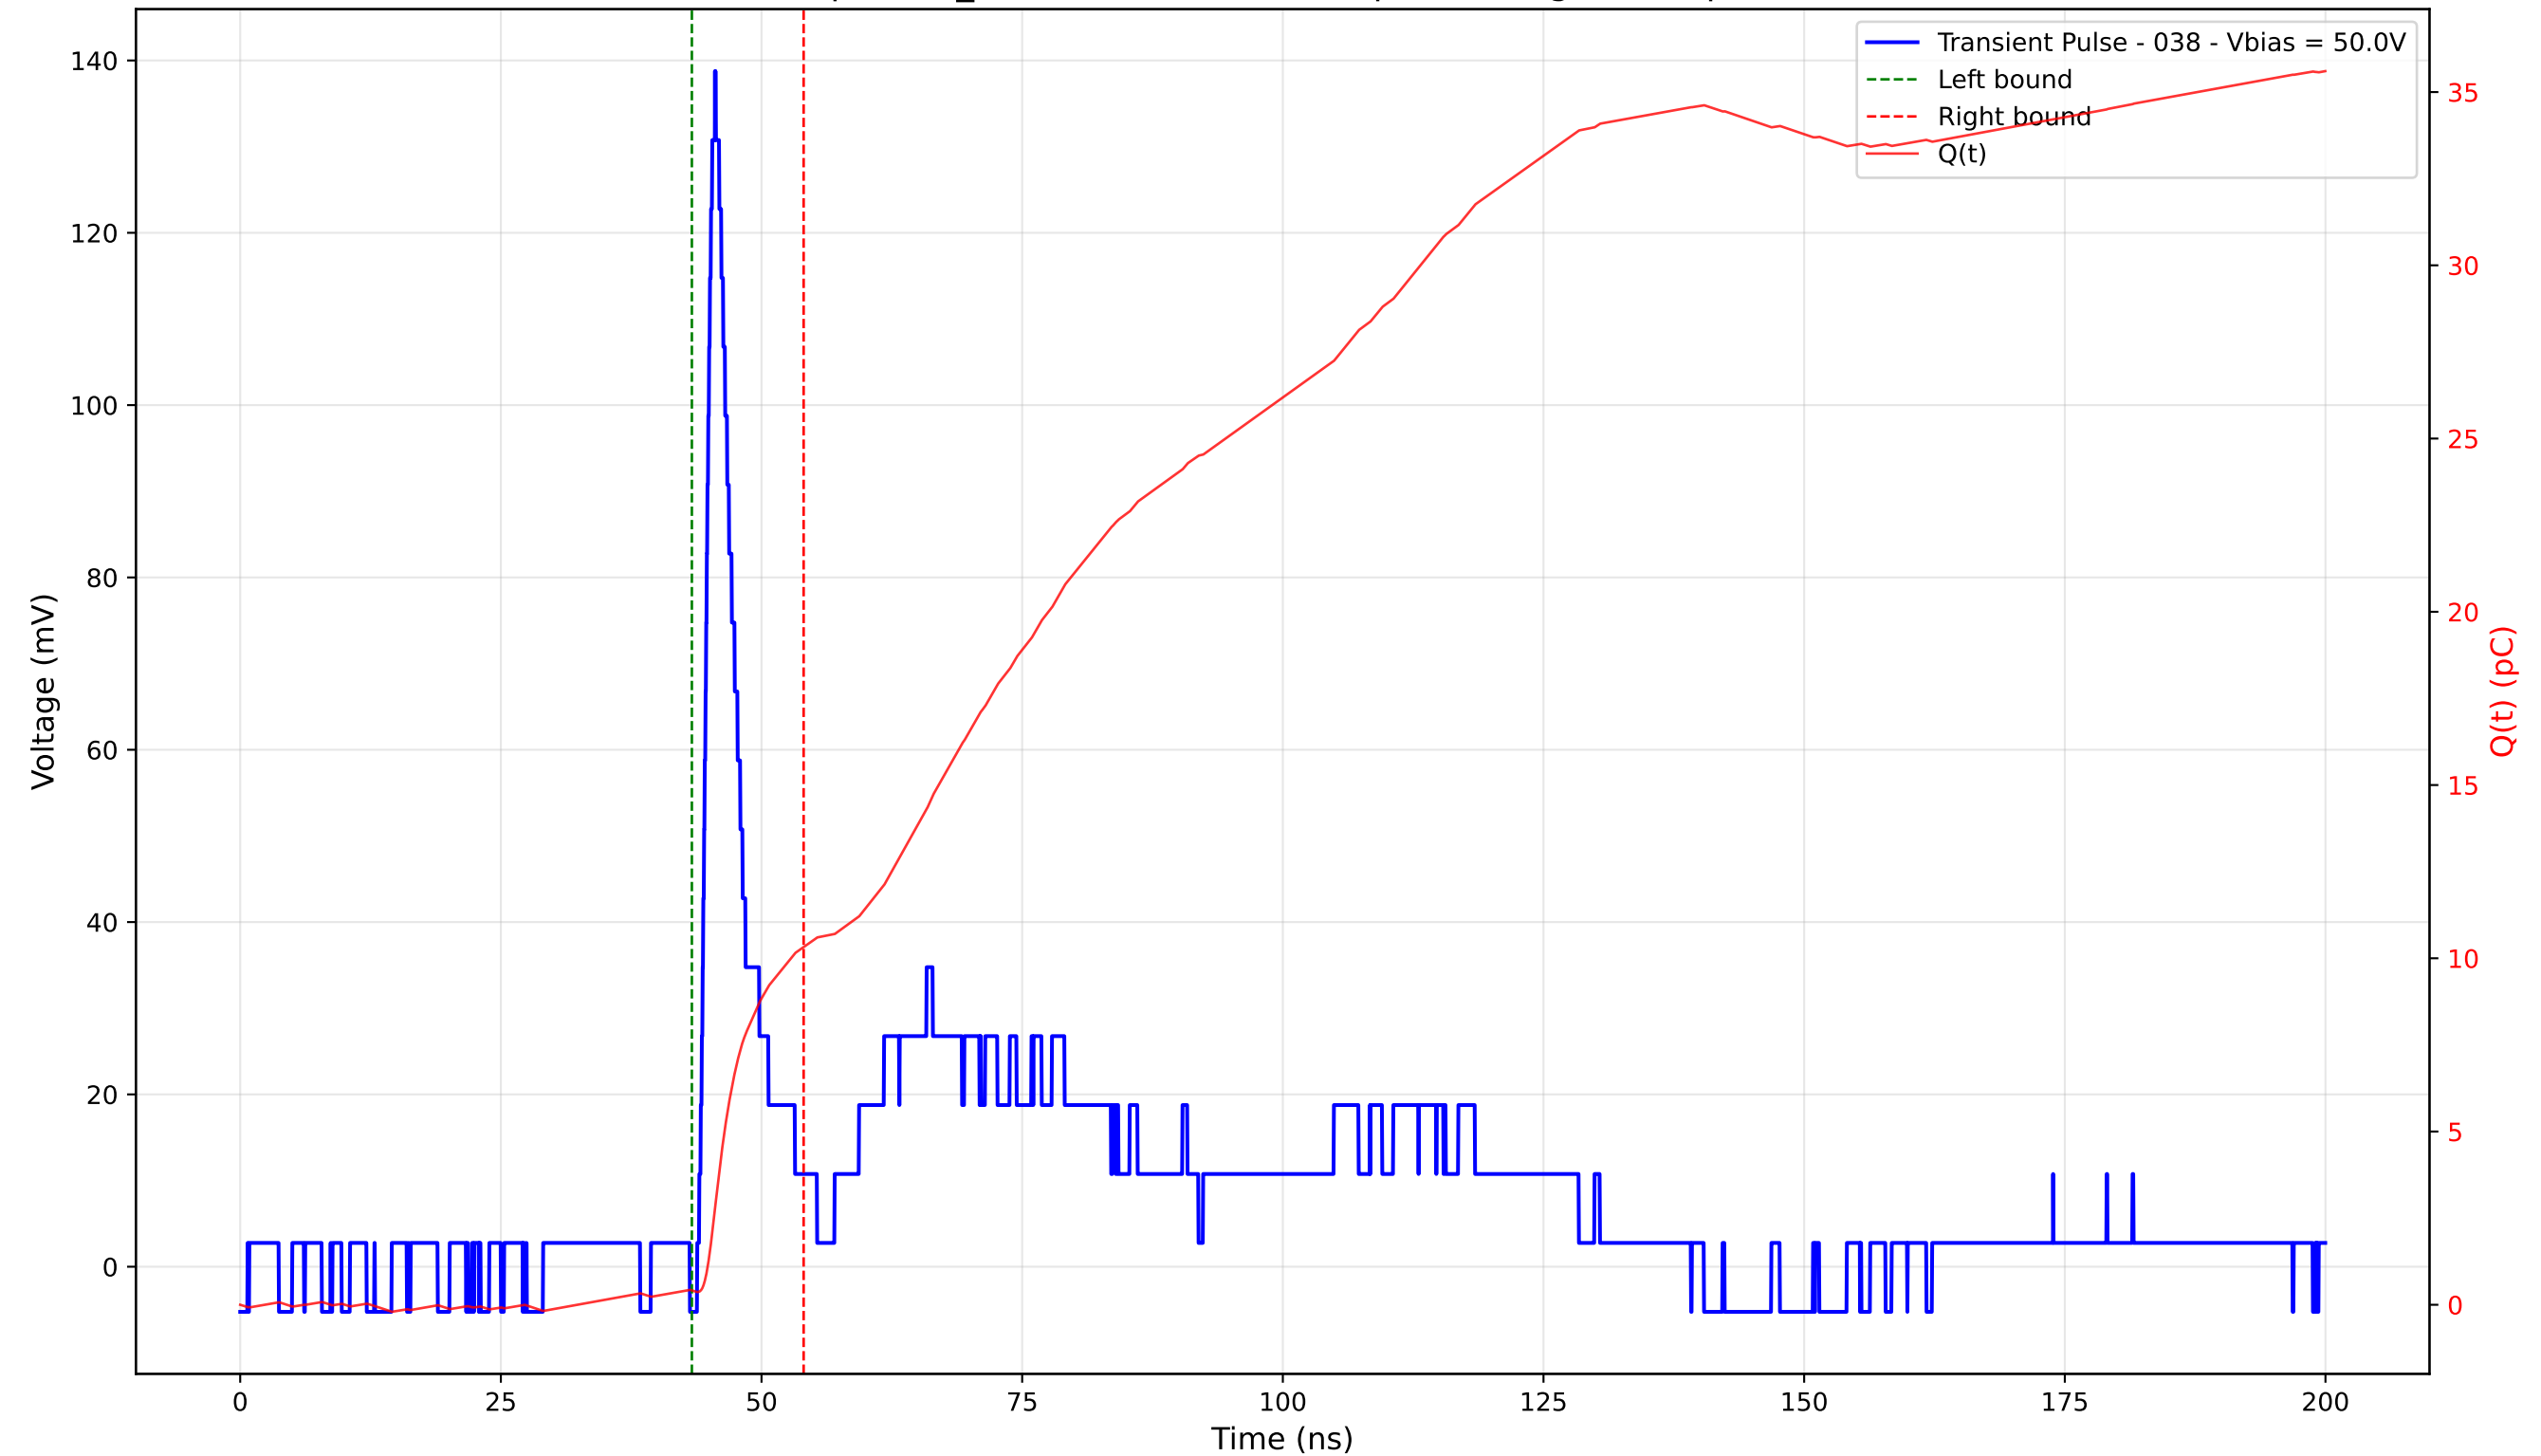


Transient Pulse - Sample: TD_4004 - Position: 345.0 μm - Charge: 10.43 pC - Rise Time: 1.07 ns

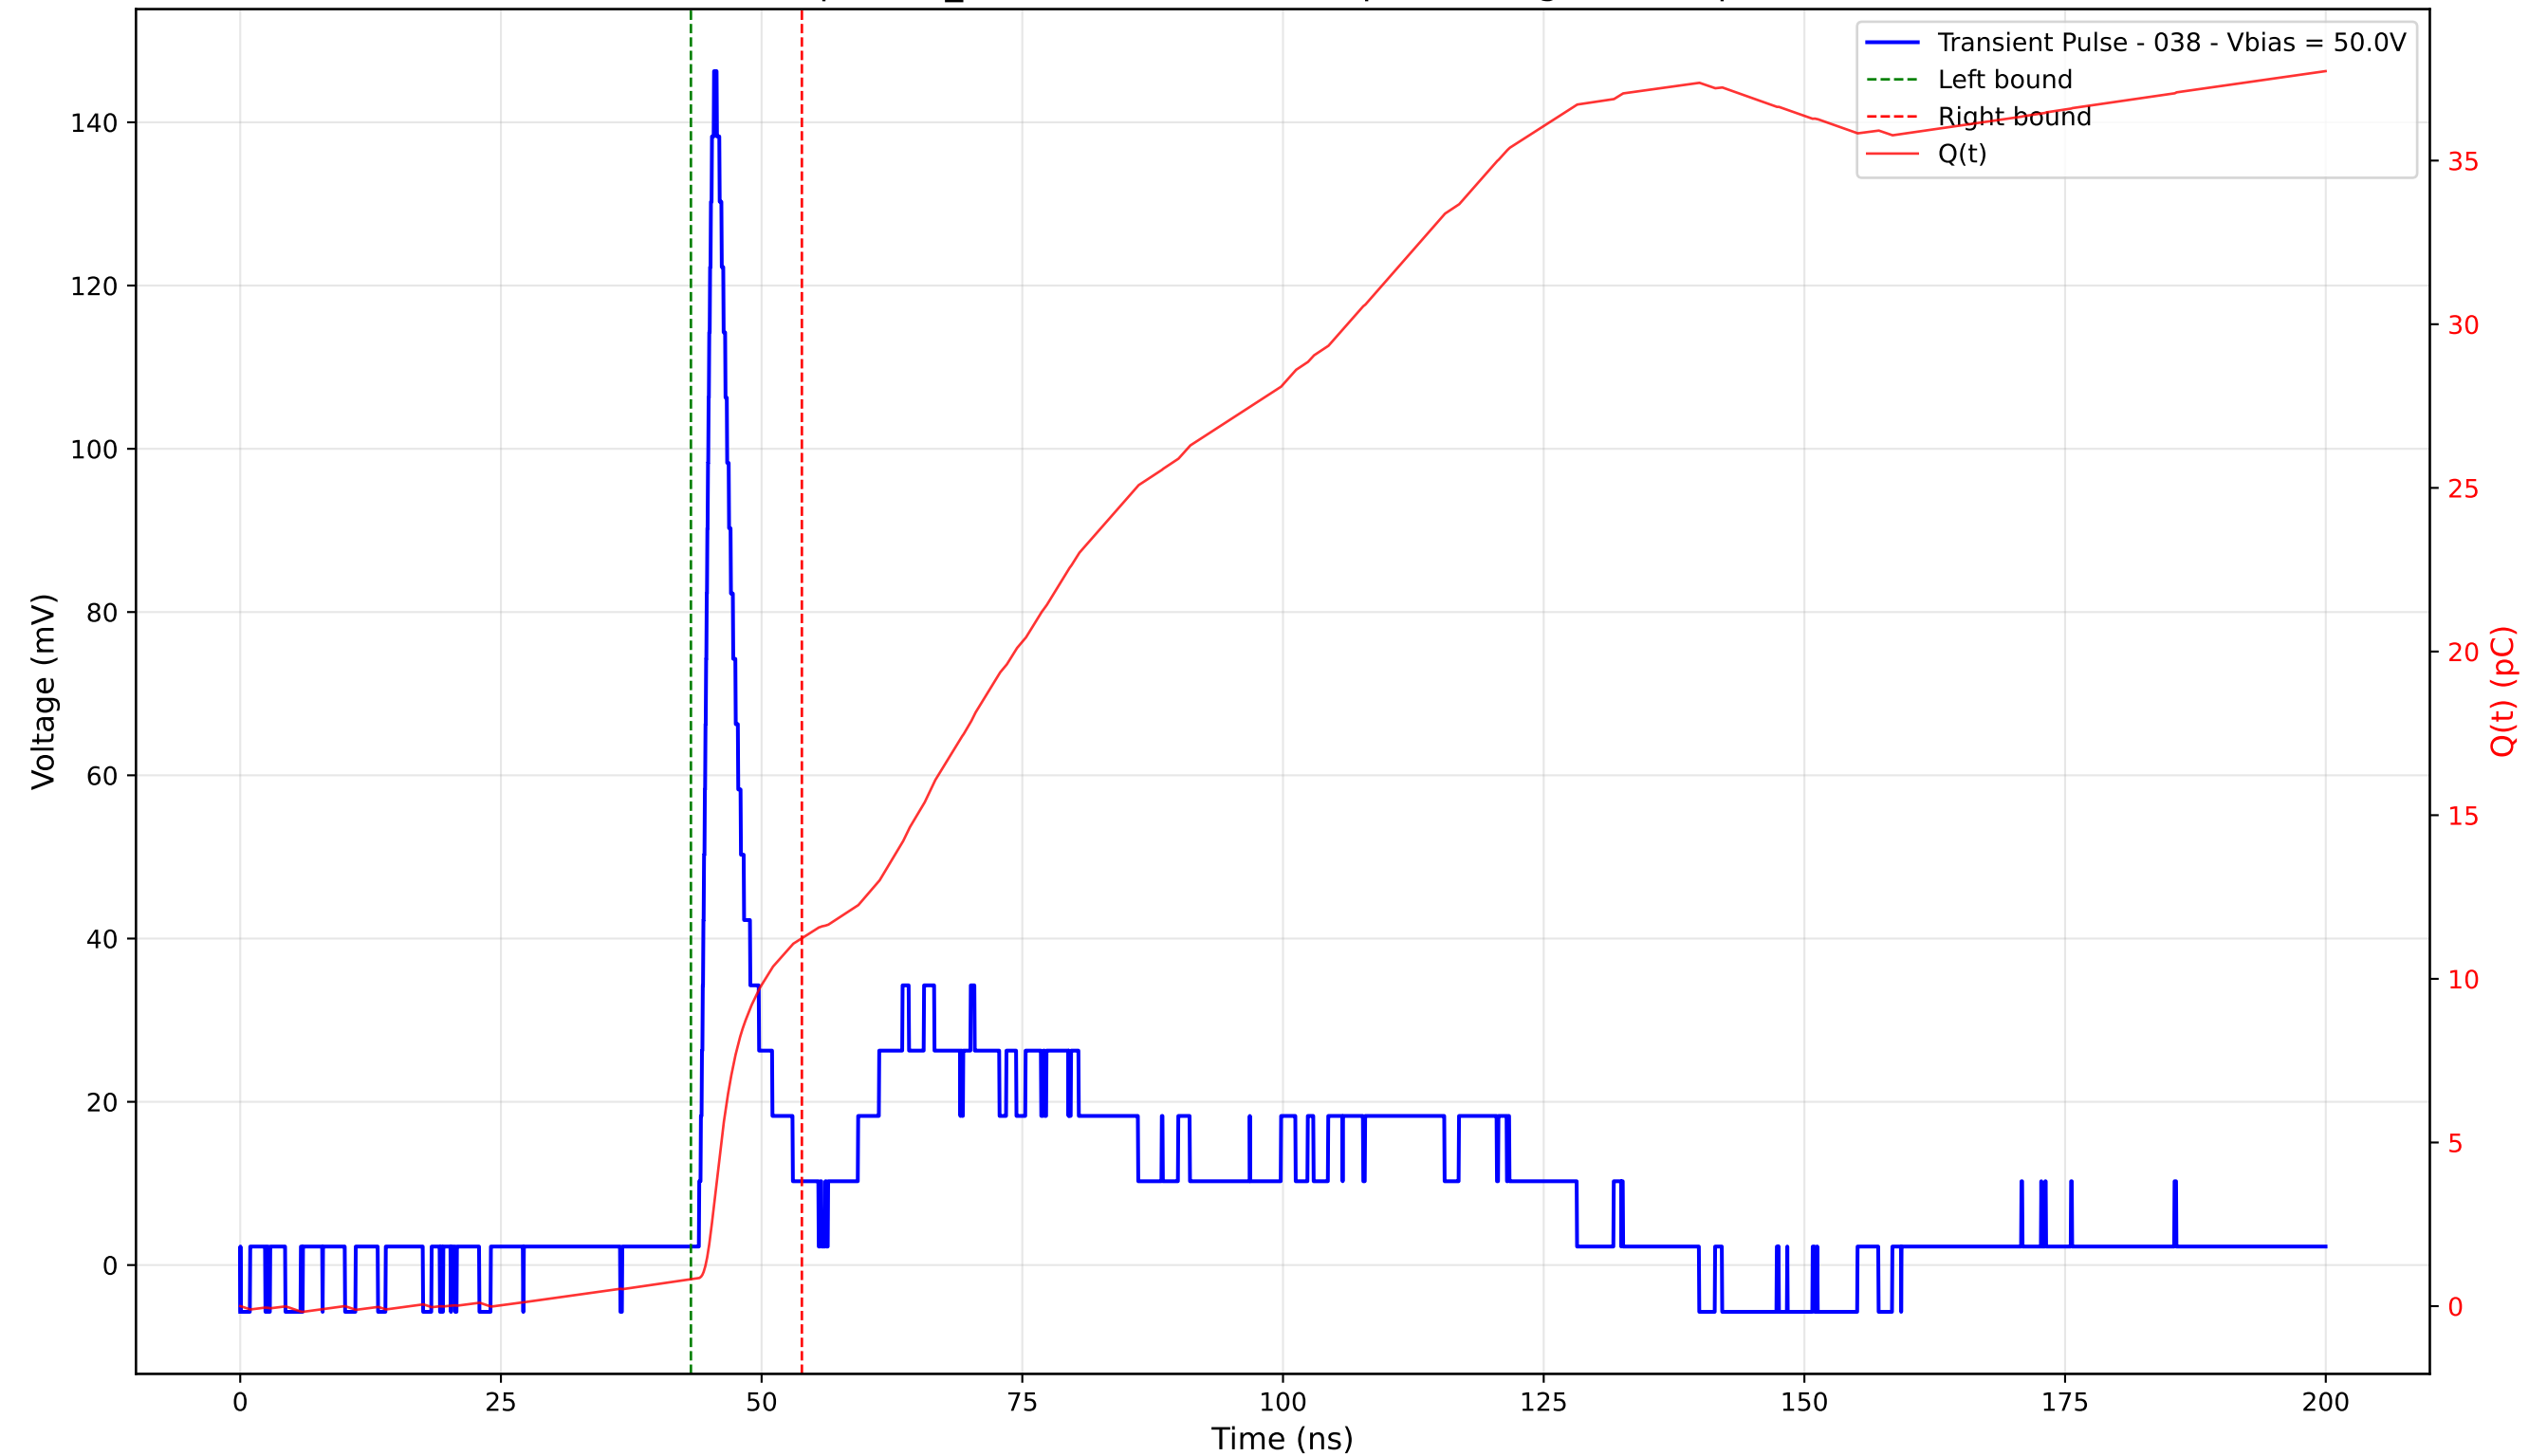


Transient Pulse - Sample: TD_4004 - Position: 350.0 μm - Charge: 10.22 pC - Rise Time: 0.97 ns

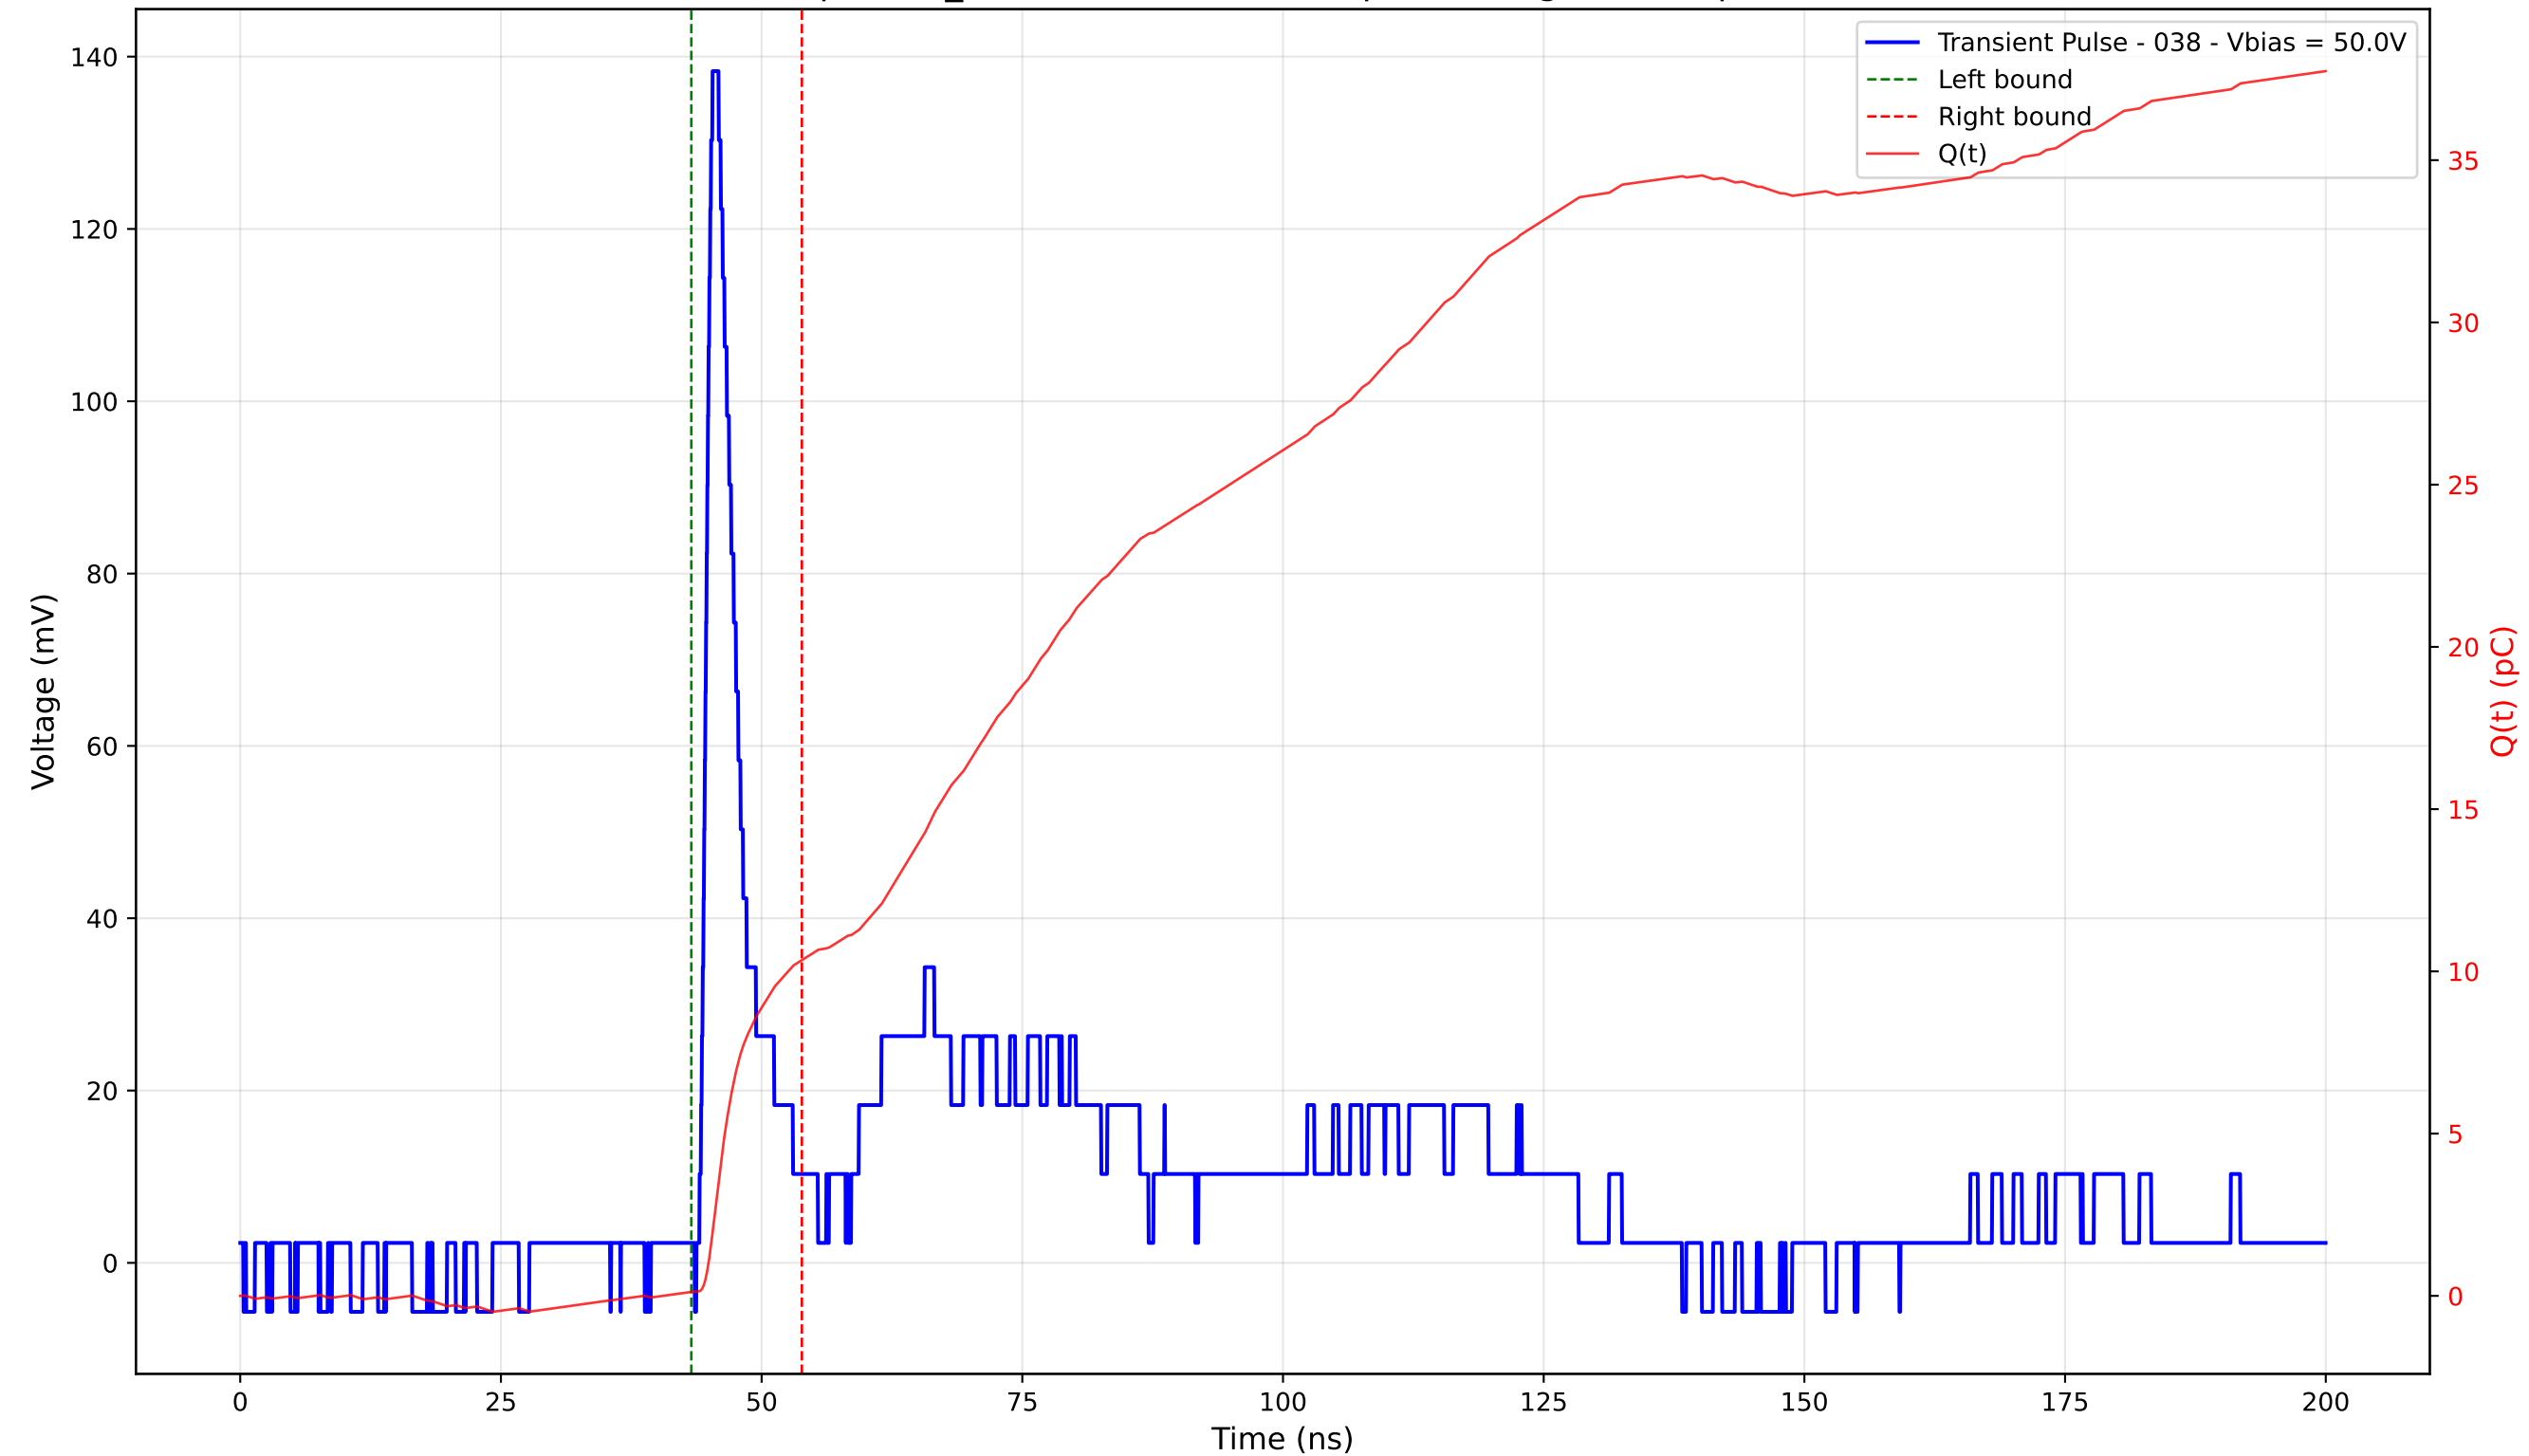


Transient Pulse - Sample: TD_4004 - Position: 355.0 μm - Charge: 10.80 pC - Rise Time: 1.02 ns

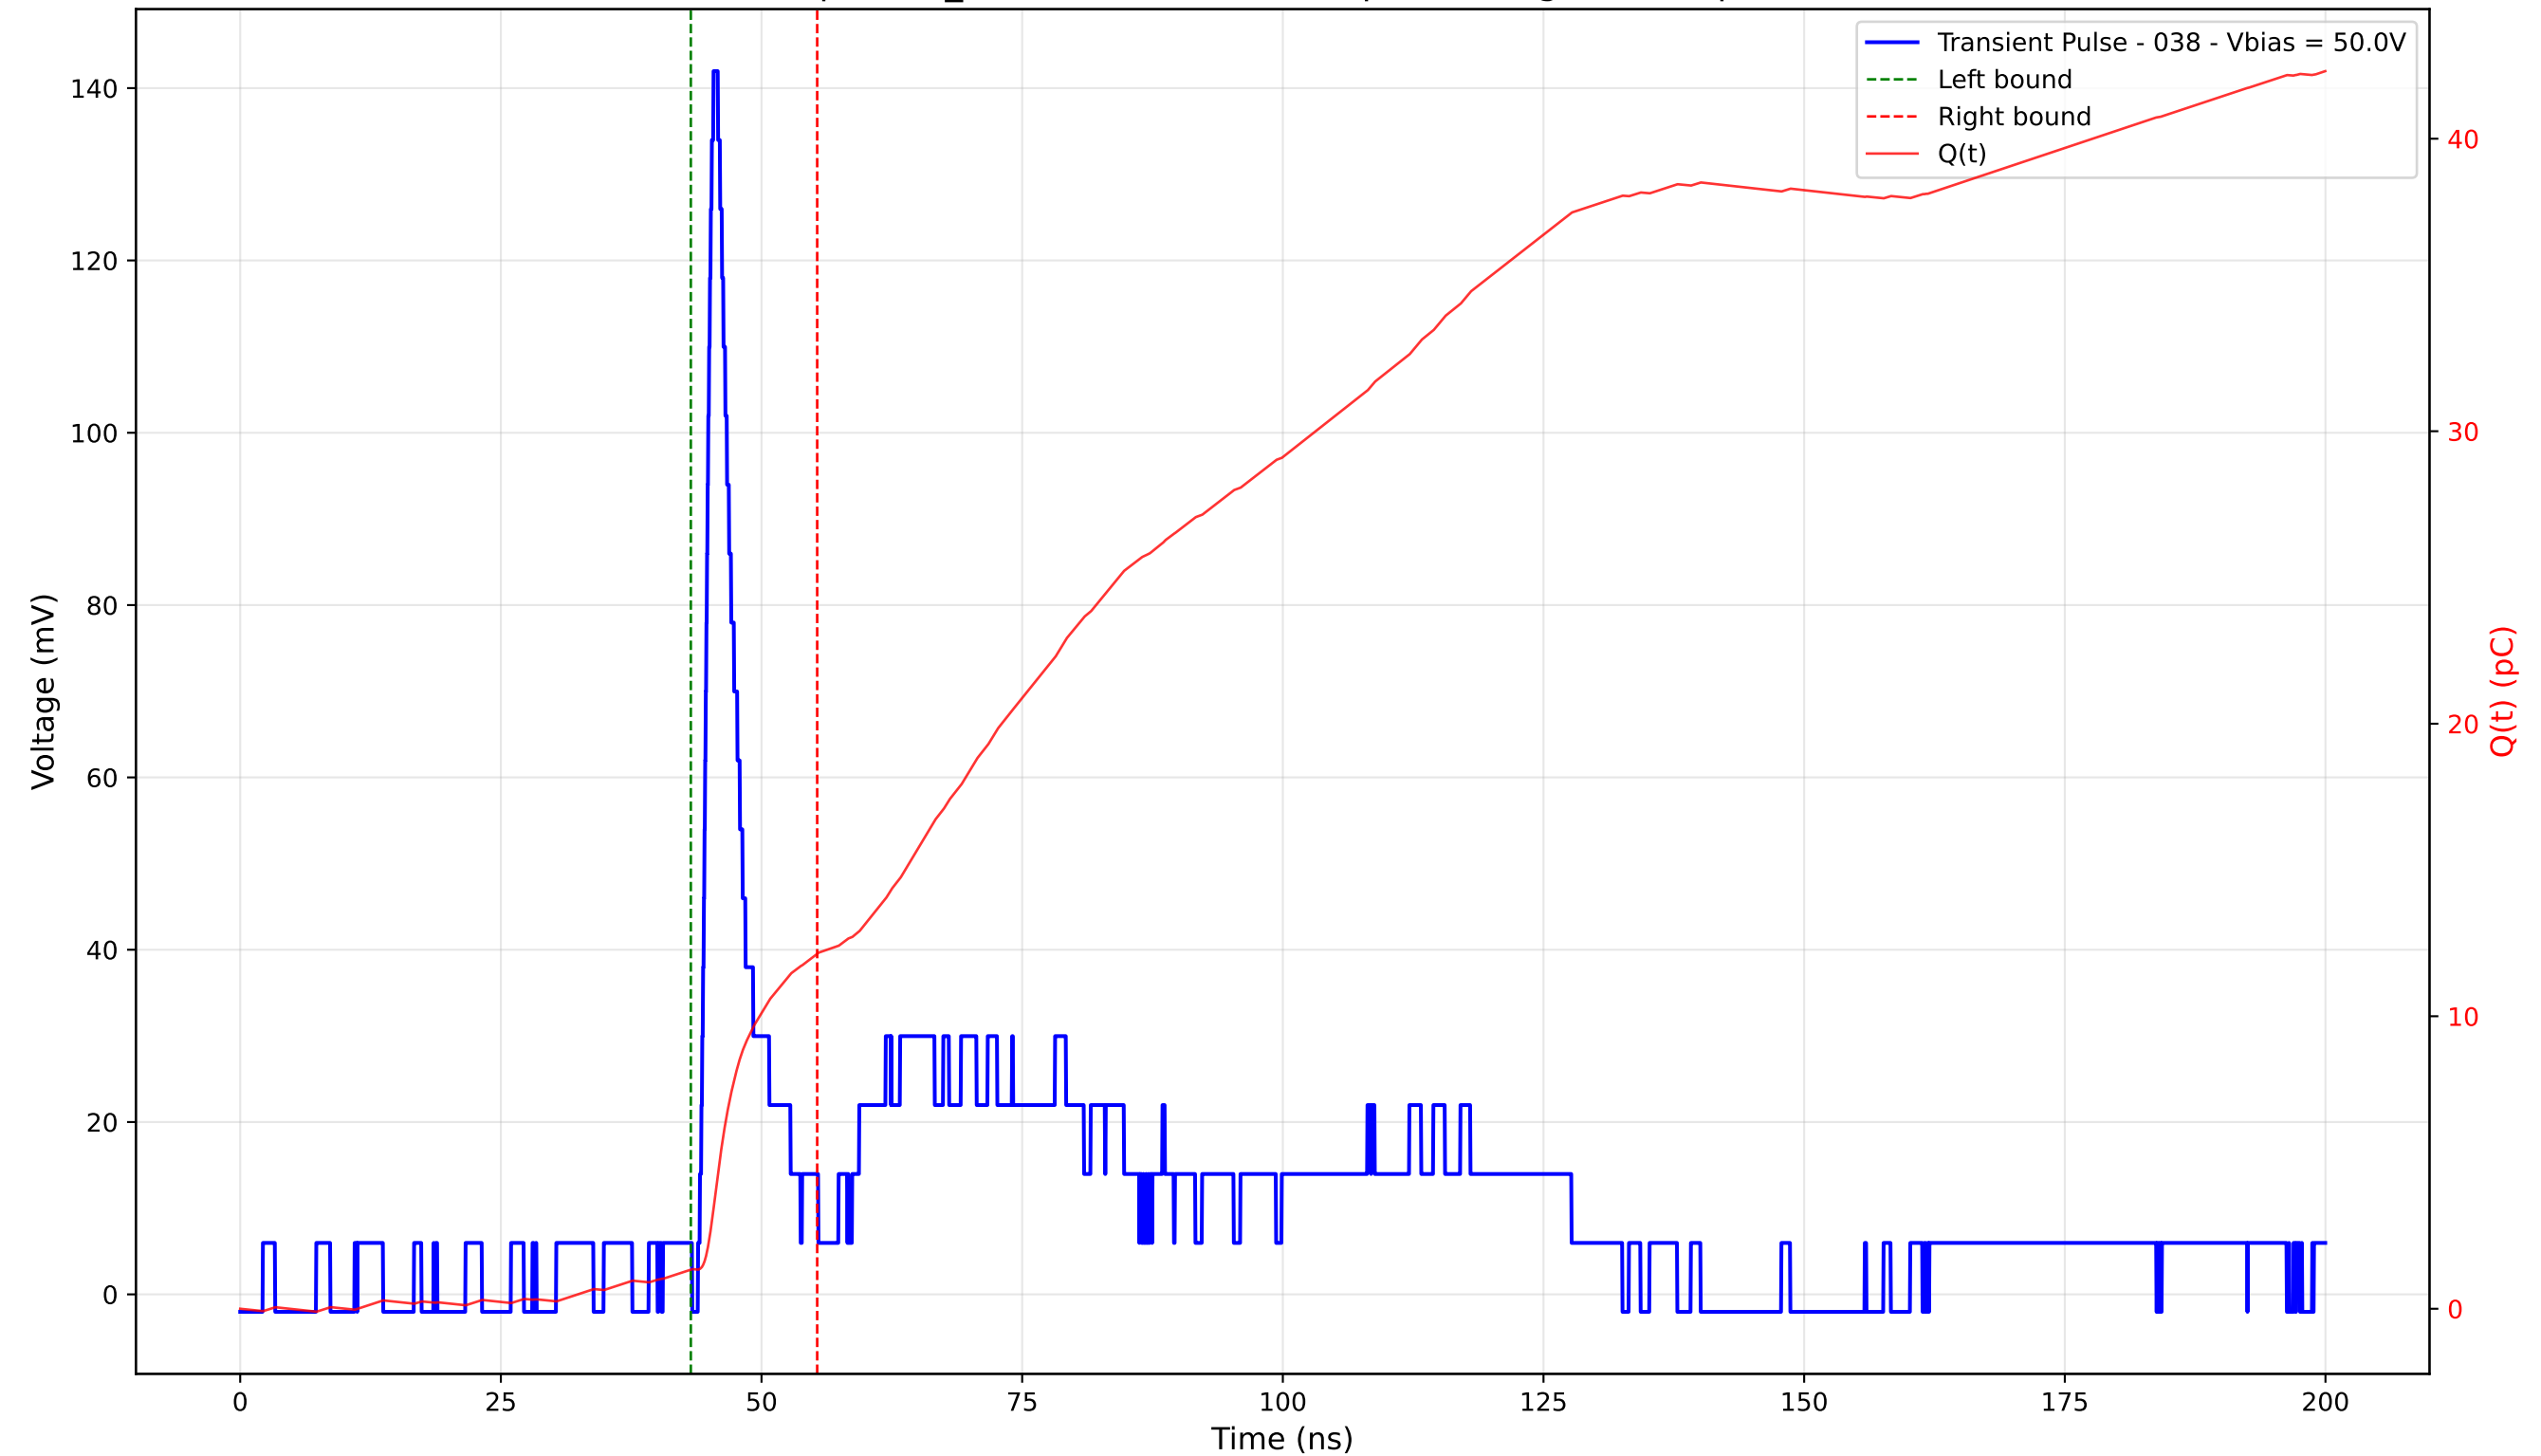


Transient Pulse - Sample: TD_4004 - Position: 360.0 μm - Charge: 20.93 pC - Rise Time: 1.03 ns

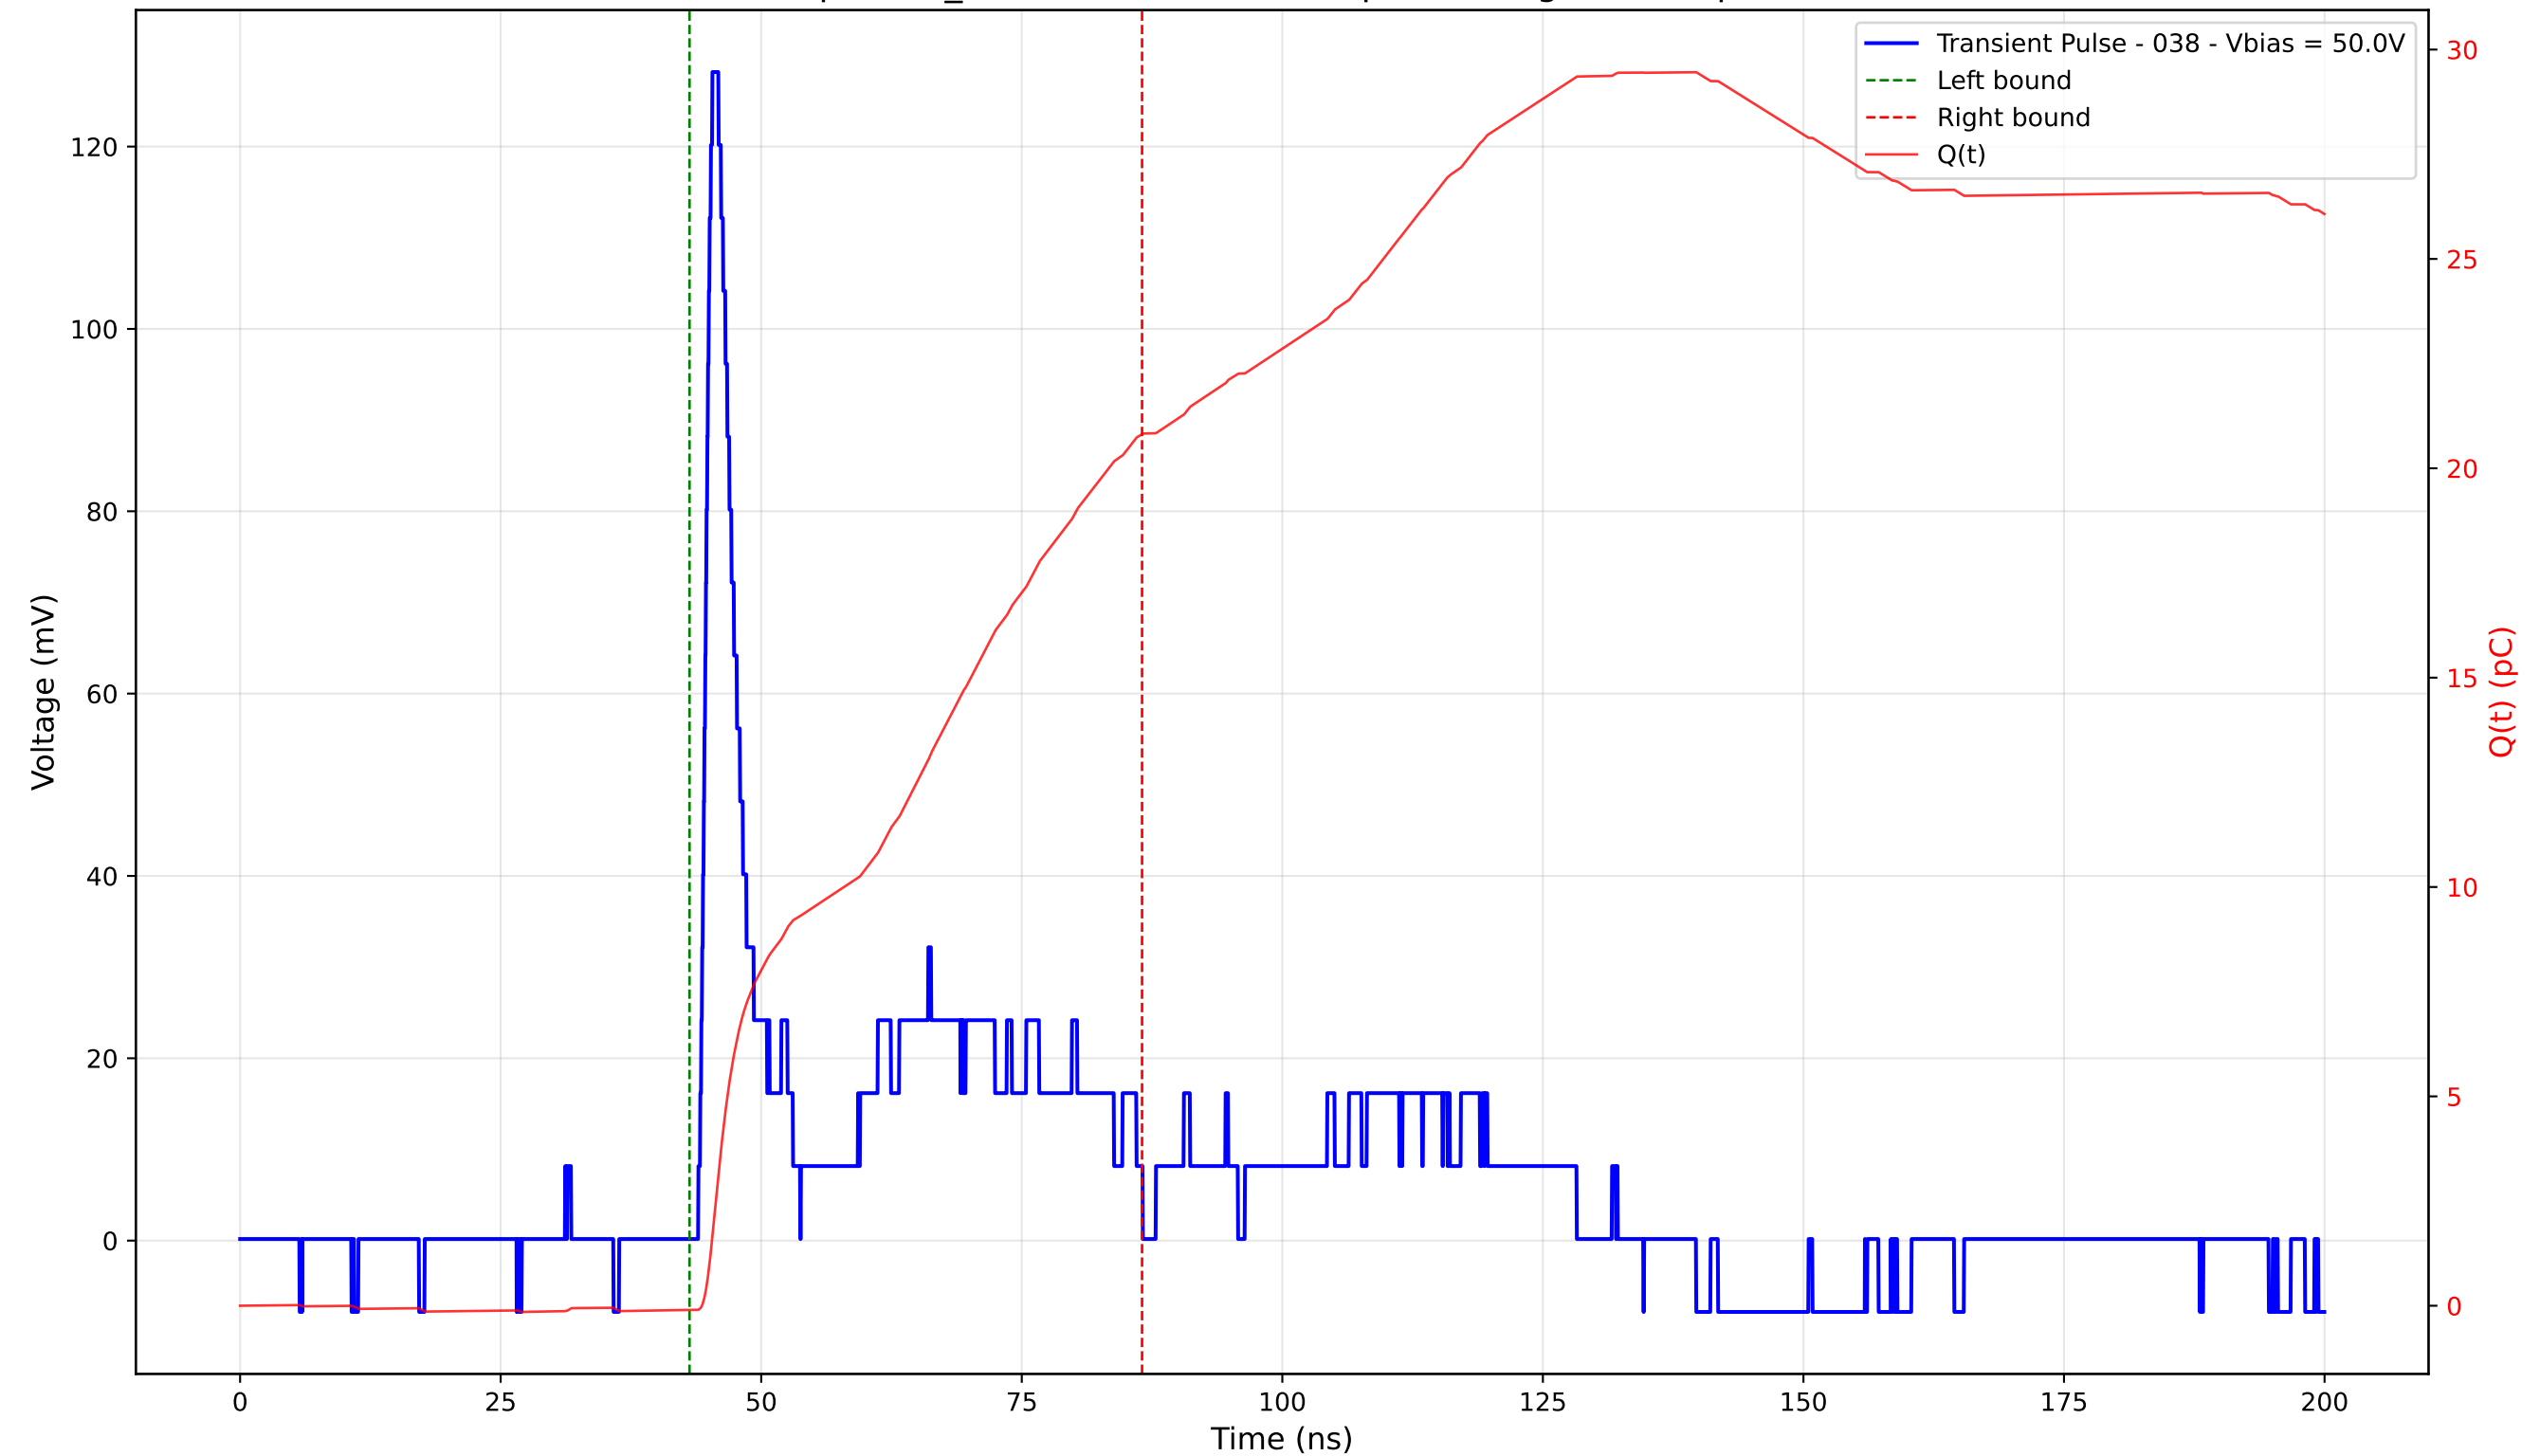


Transient Pulse - Sample: TD_4004 - Position: 365.0 μm - Charge: 8.66 pC - Rise Time: 1.01 ns

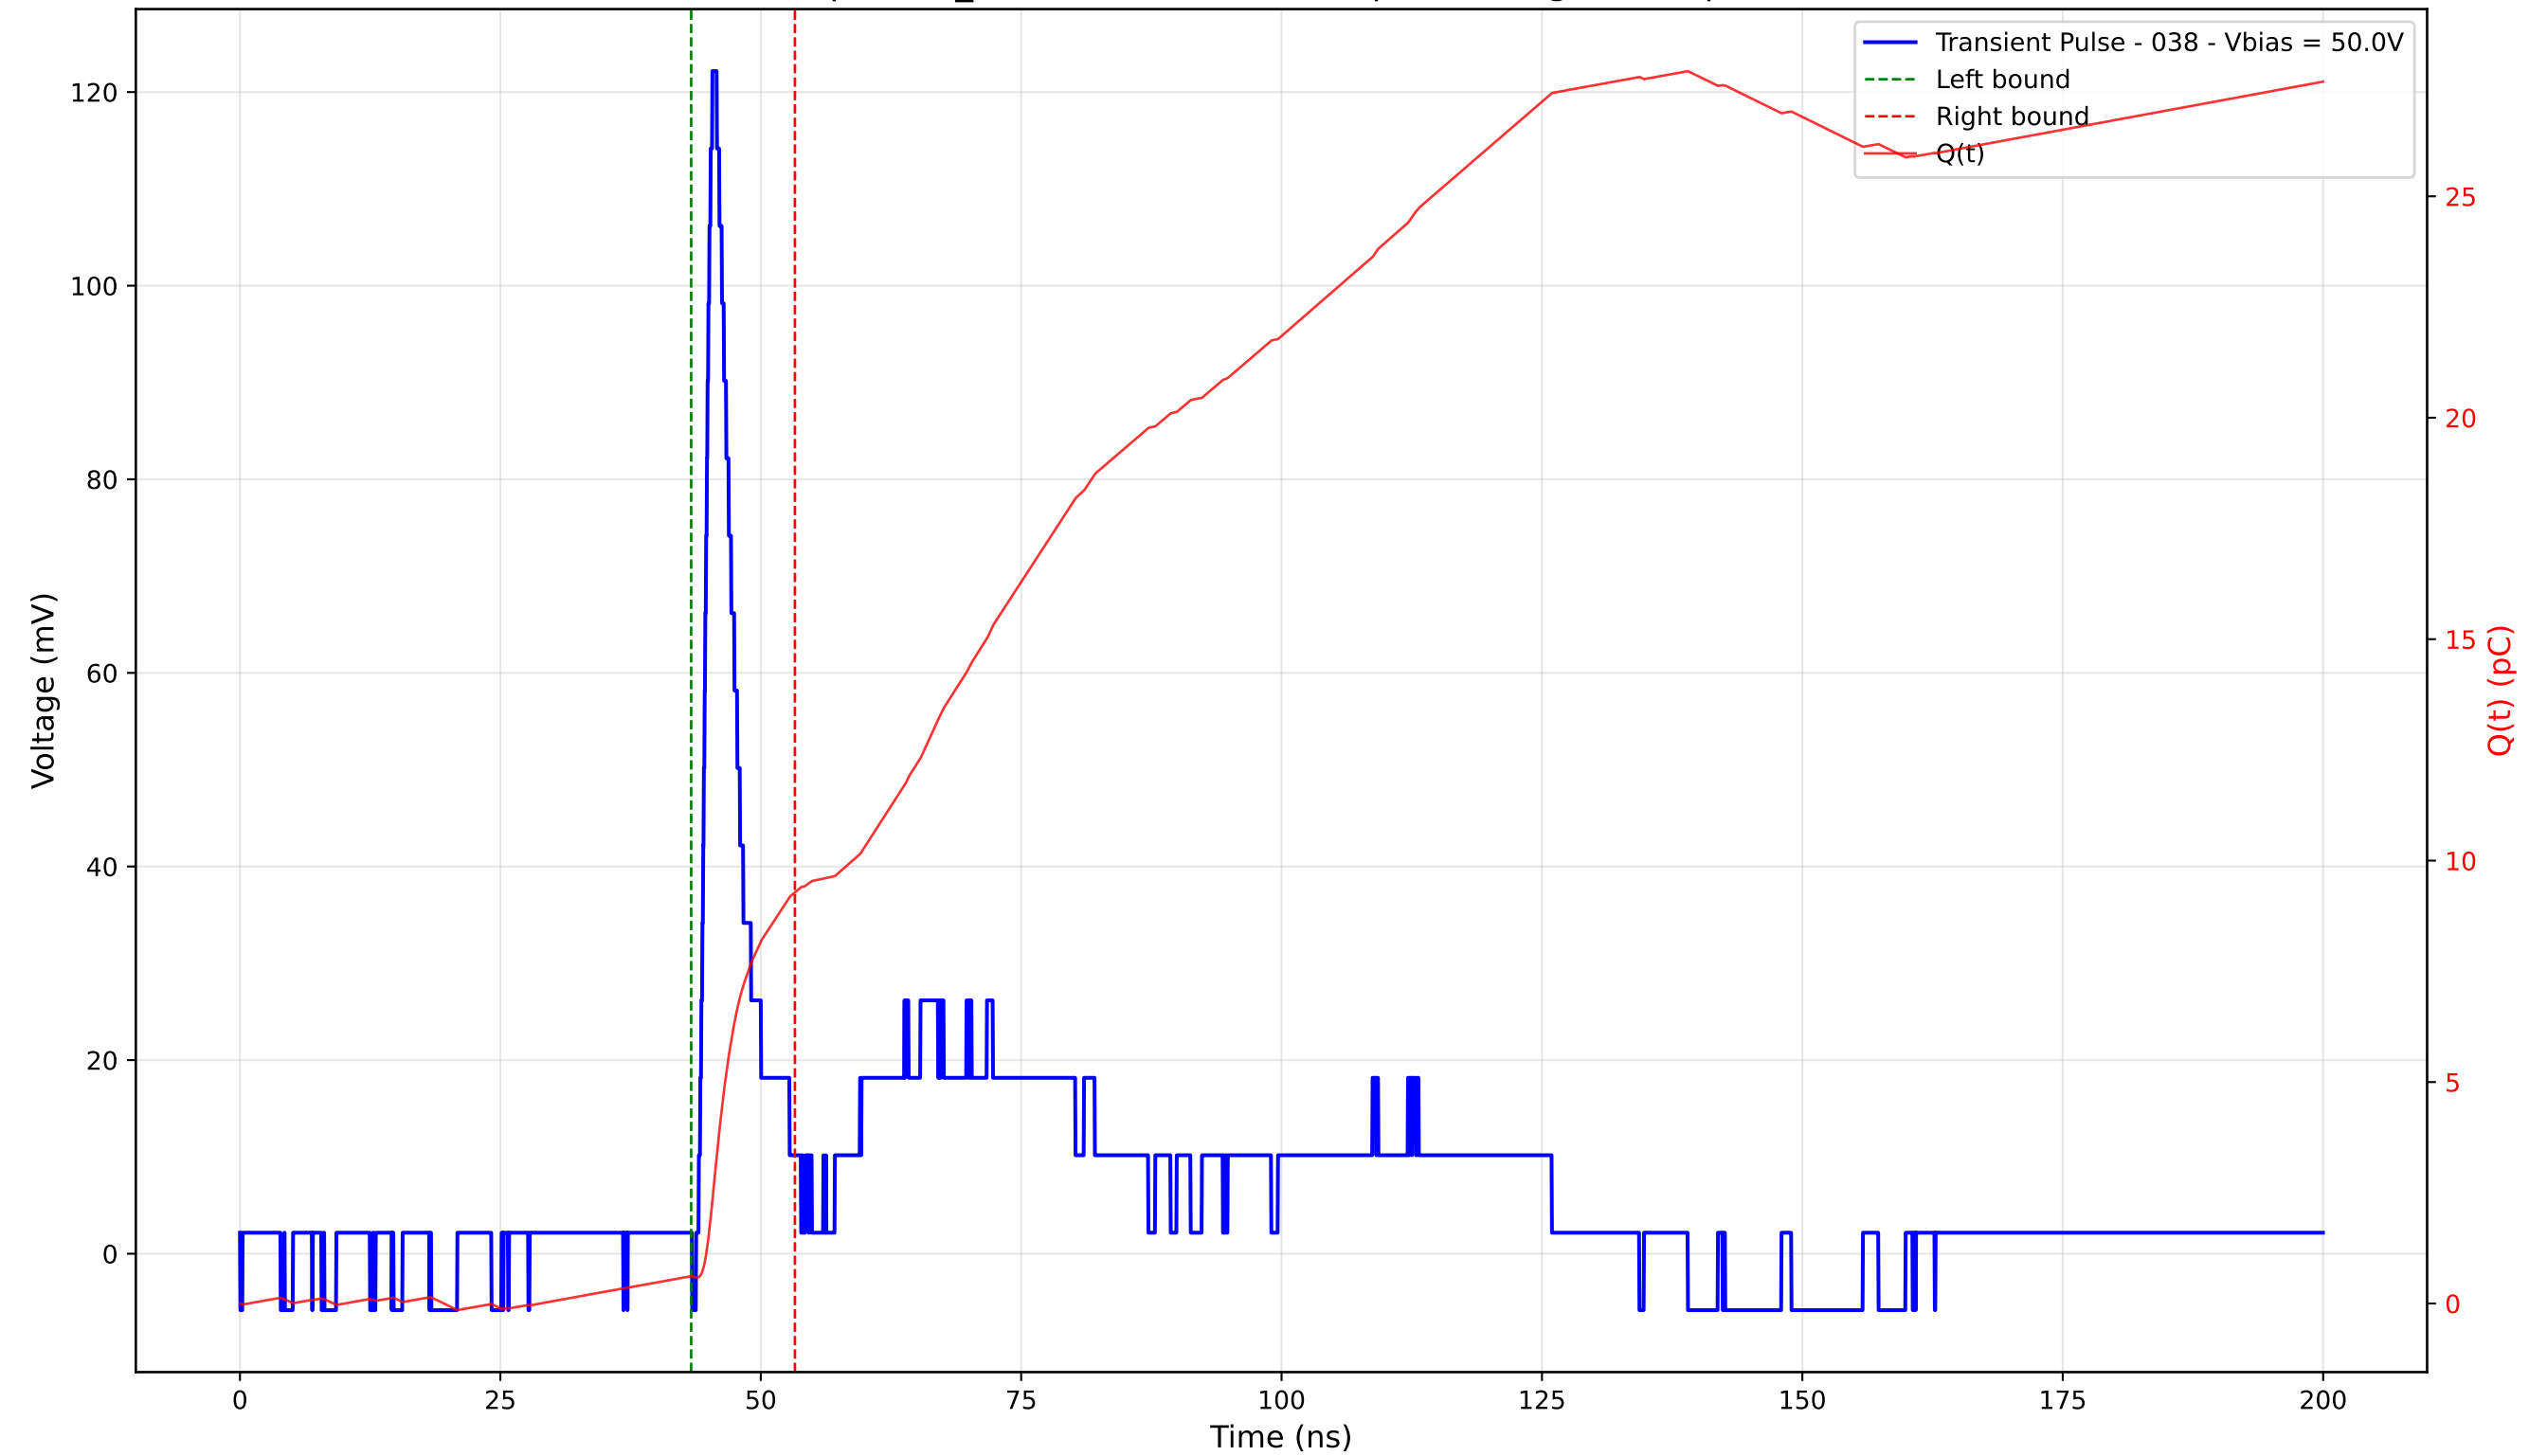


Transient Pulse - Sample: TD_4004 - Position: 370.0 μm - Charge: 7.96 pC - Rise Time: 0.92 ns

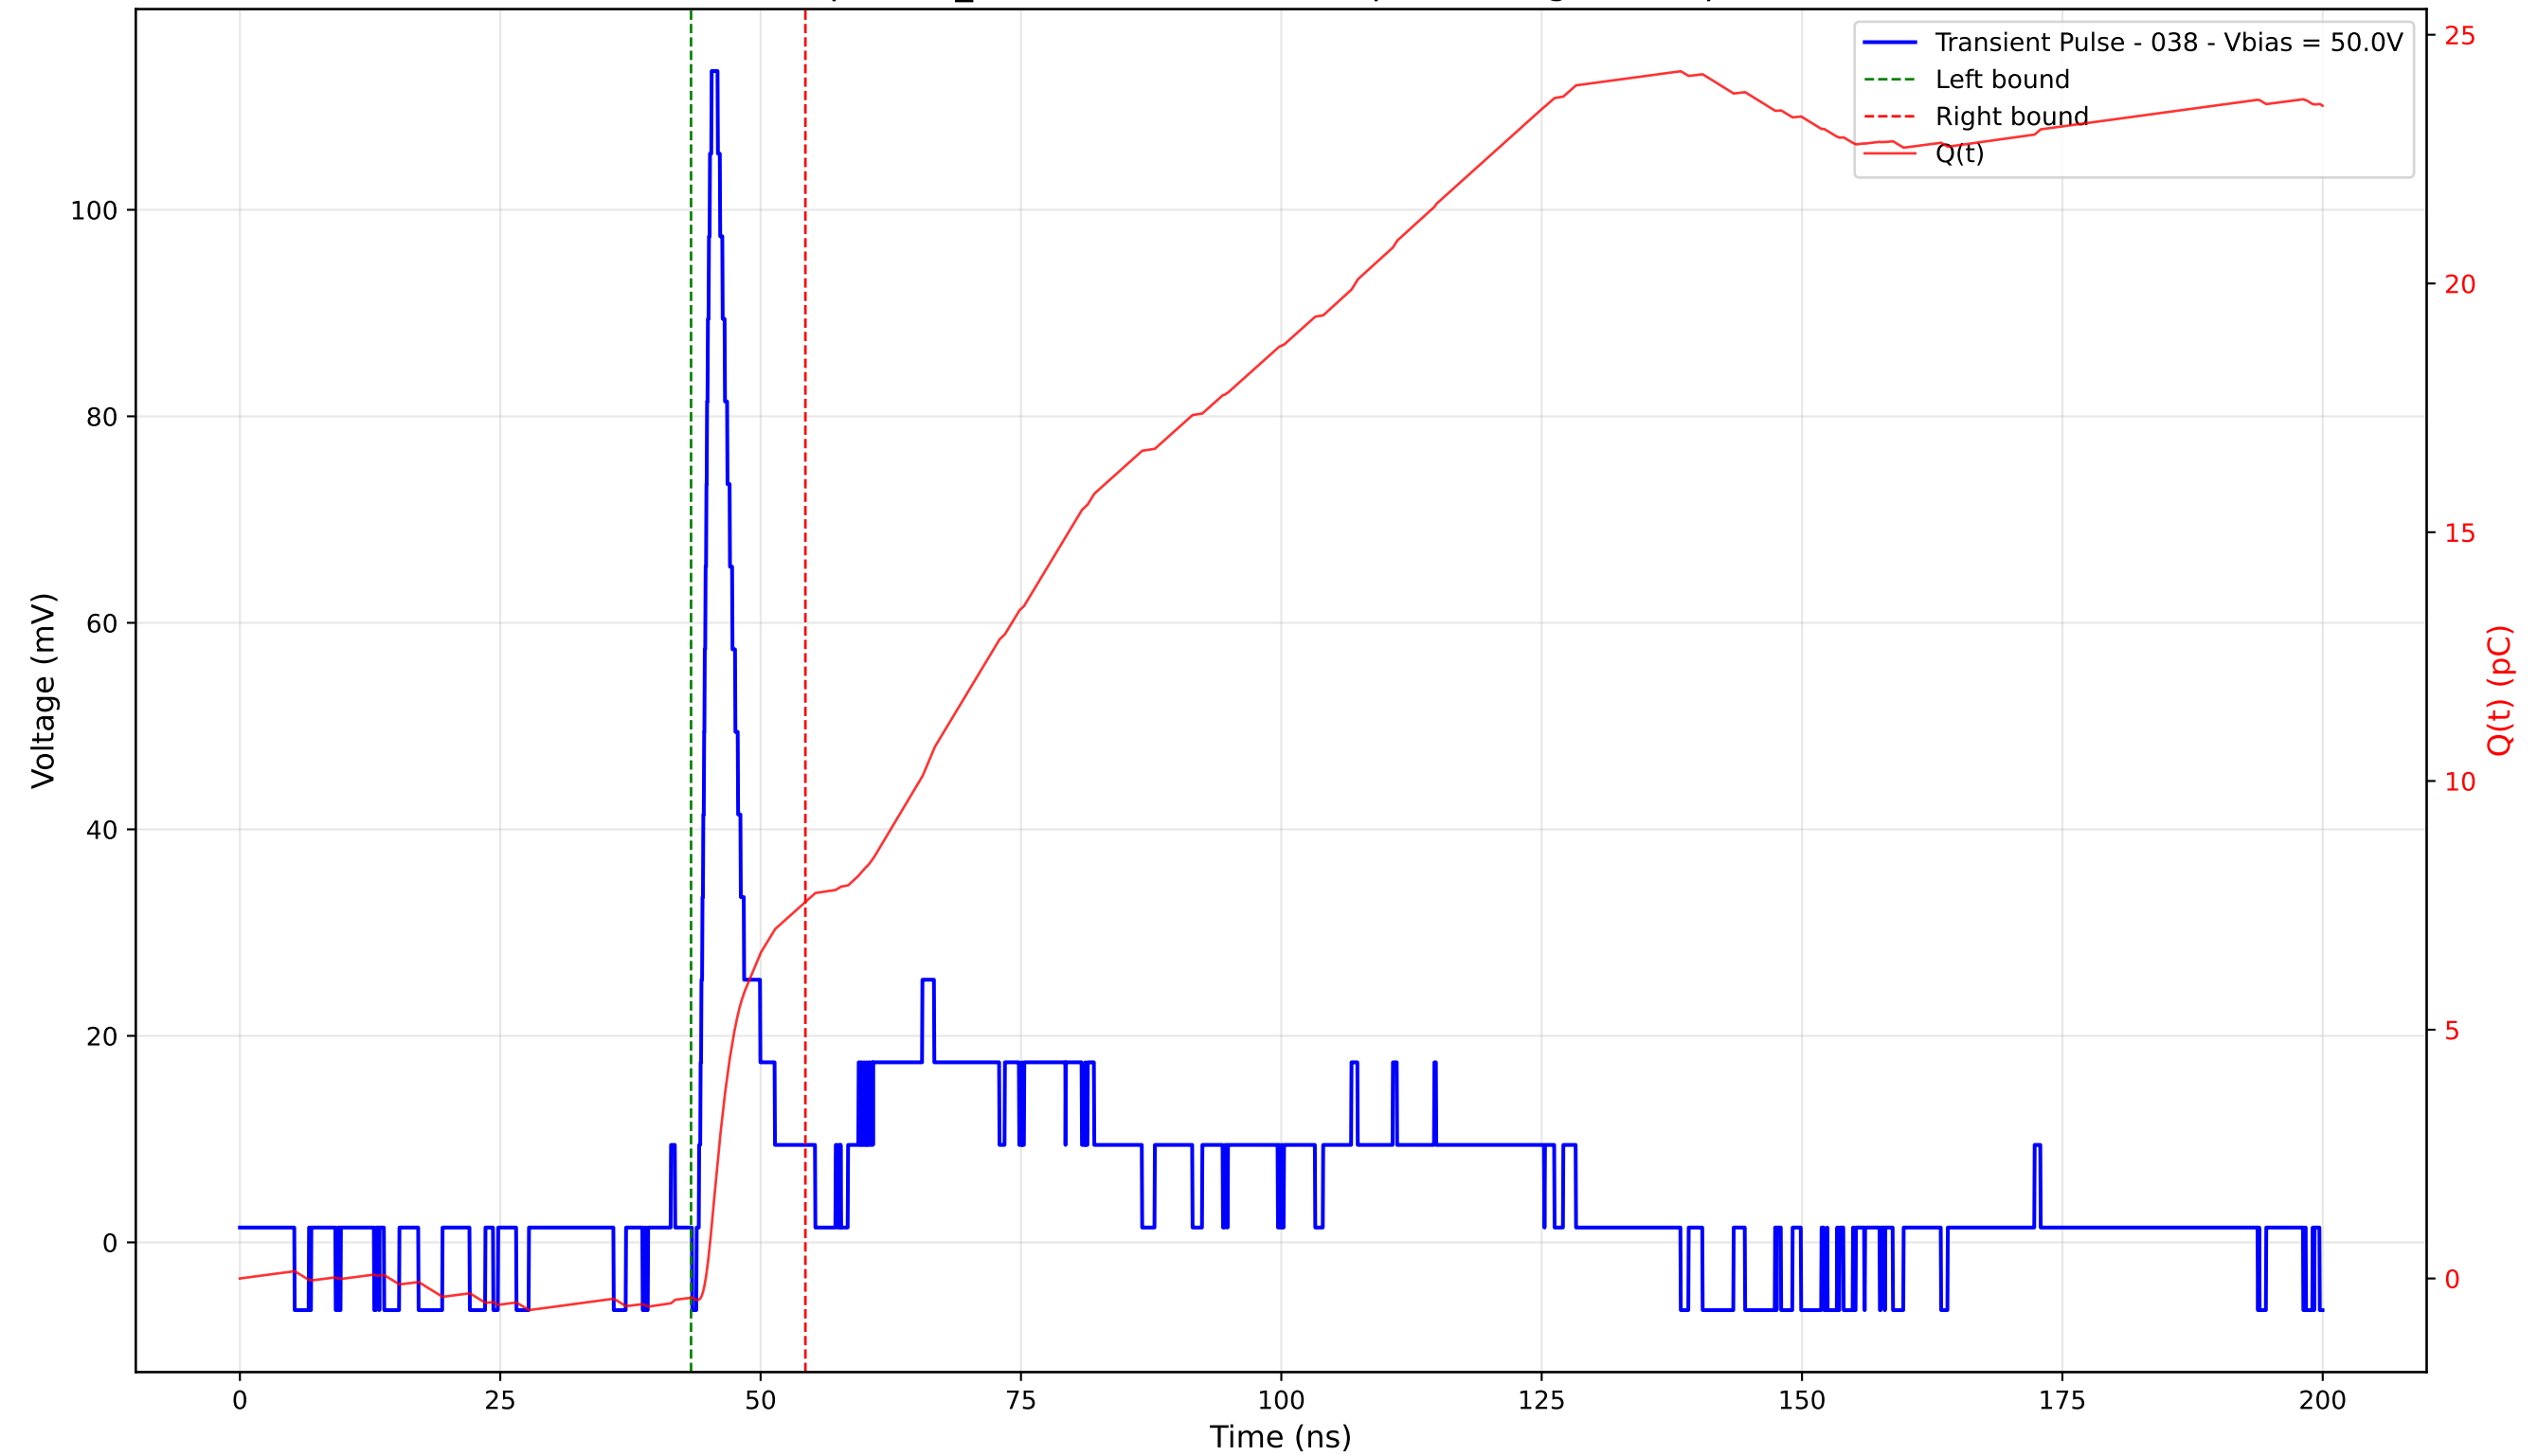


Transient Pulse - Sample: TD_4004 - Position: 375.0 μm - Charge: 8.59 pC - Rise Time: 0.96 ns

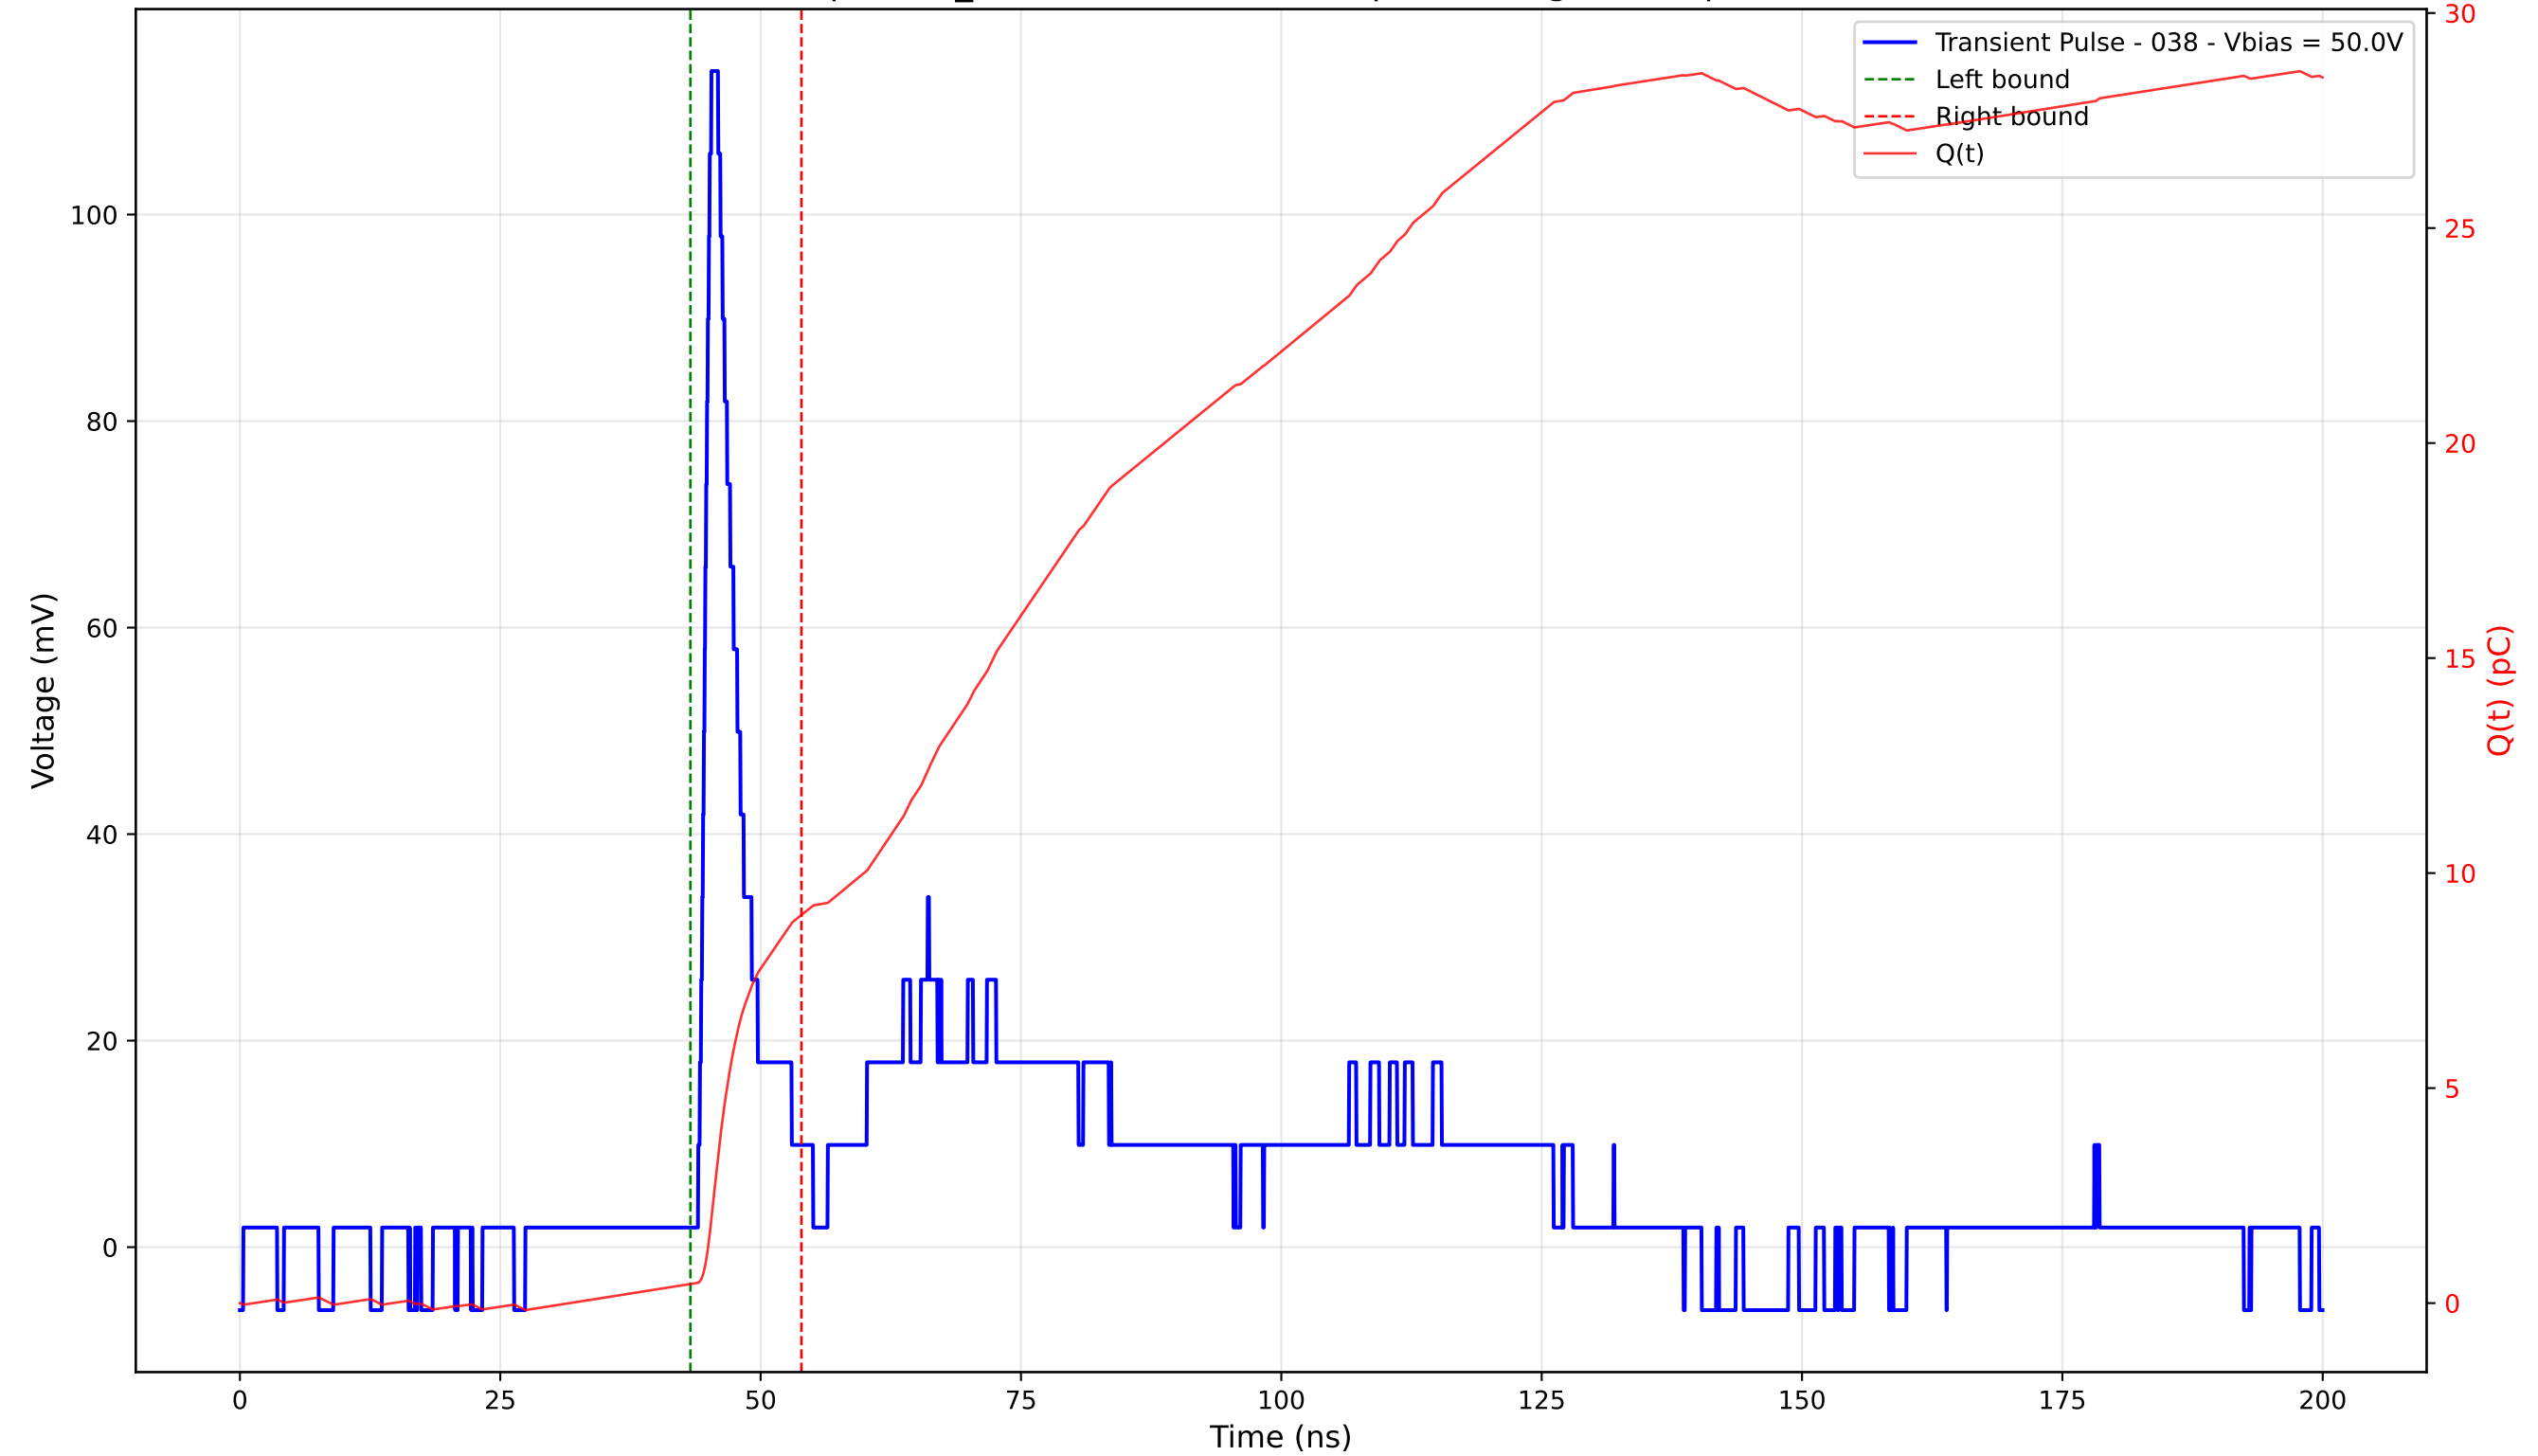


Transient Pulse - Sample: TD_4004 - Position: 380.0 μm - Charge: 9.16 pC - Rise Time: 1.07 ns

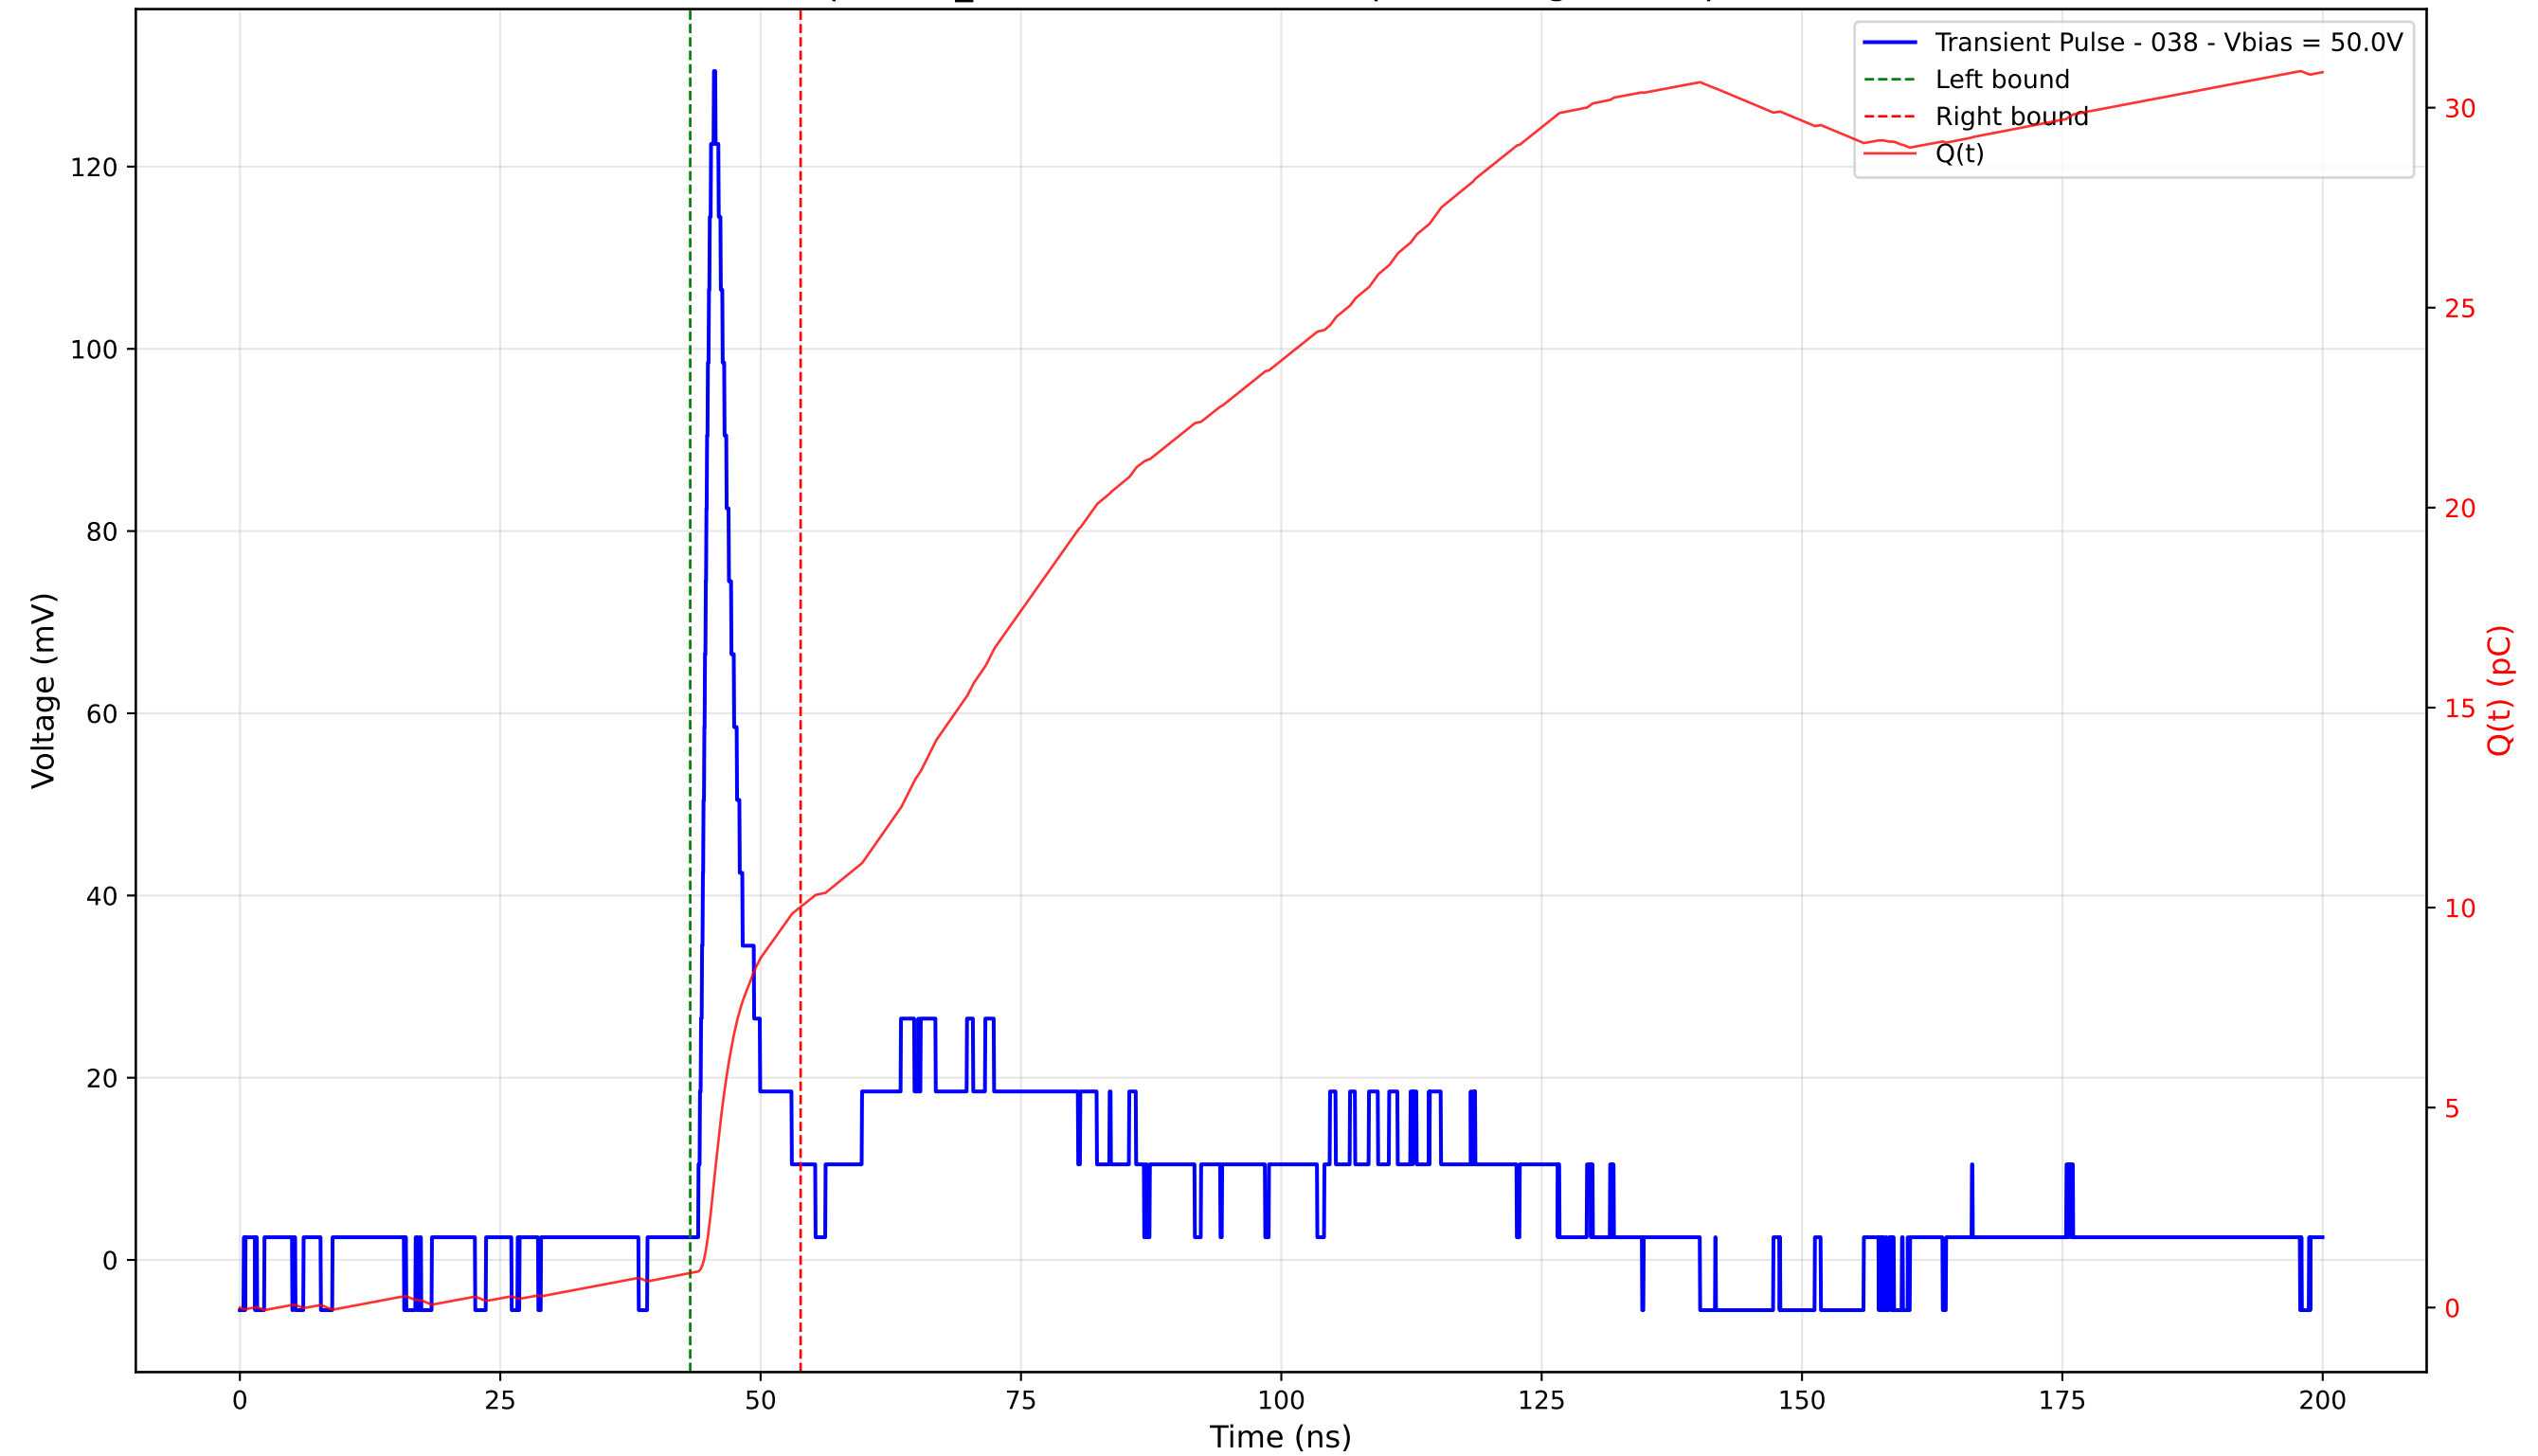


Transient Pulse - Sample: TD_4004 - Position: 385.0 μm - Charge: 8.49 pC - Rise Time: 1.00 ns

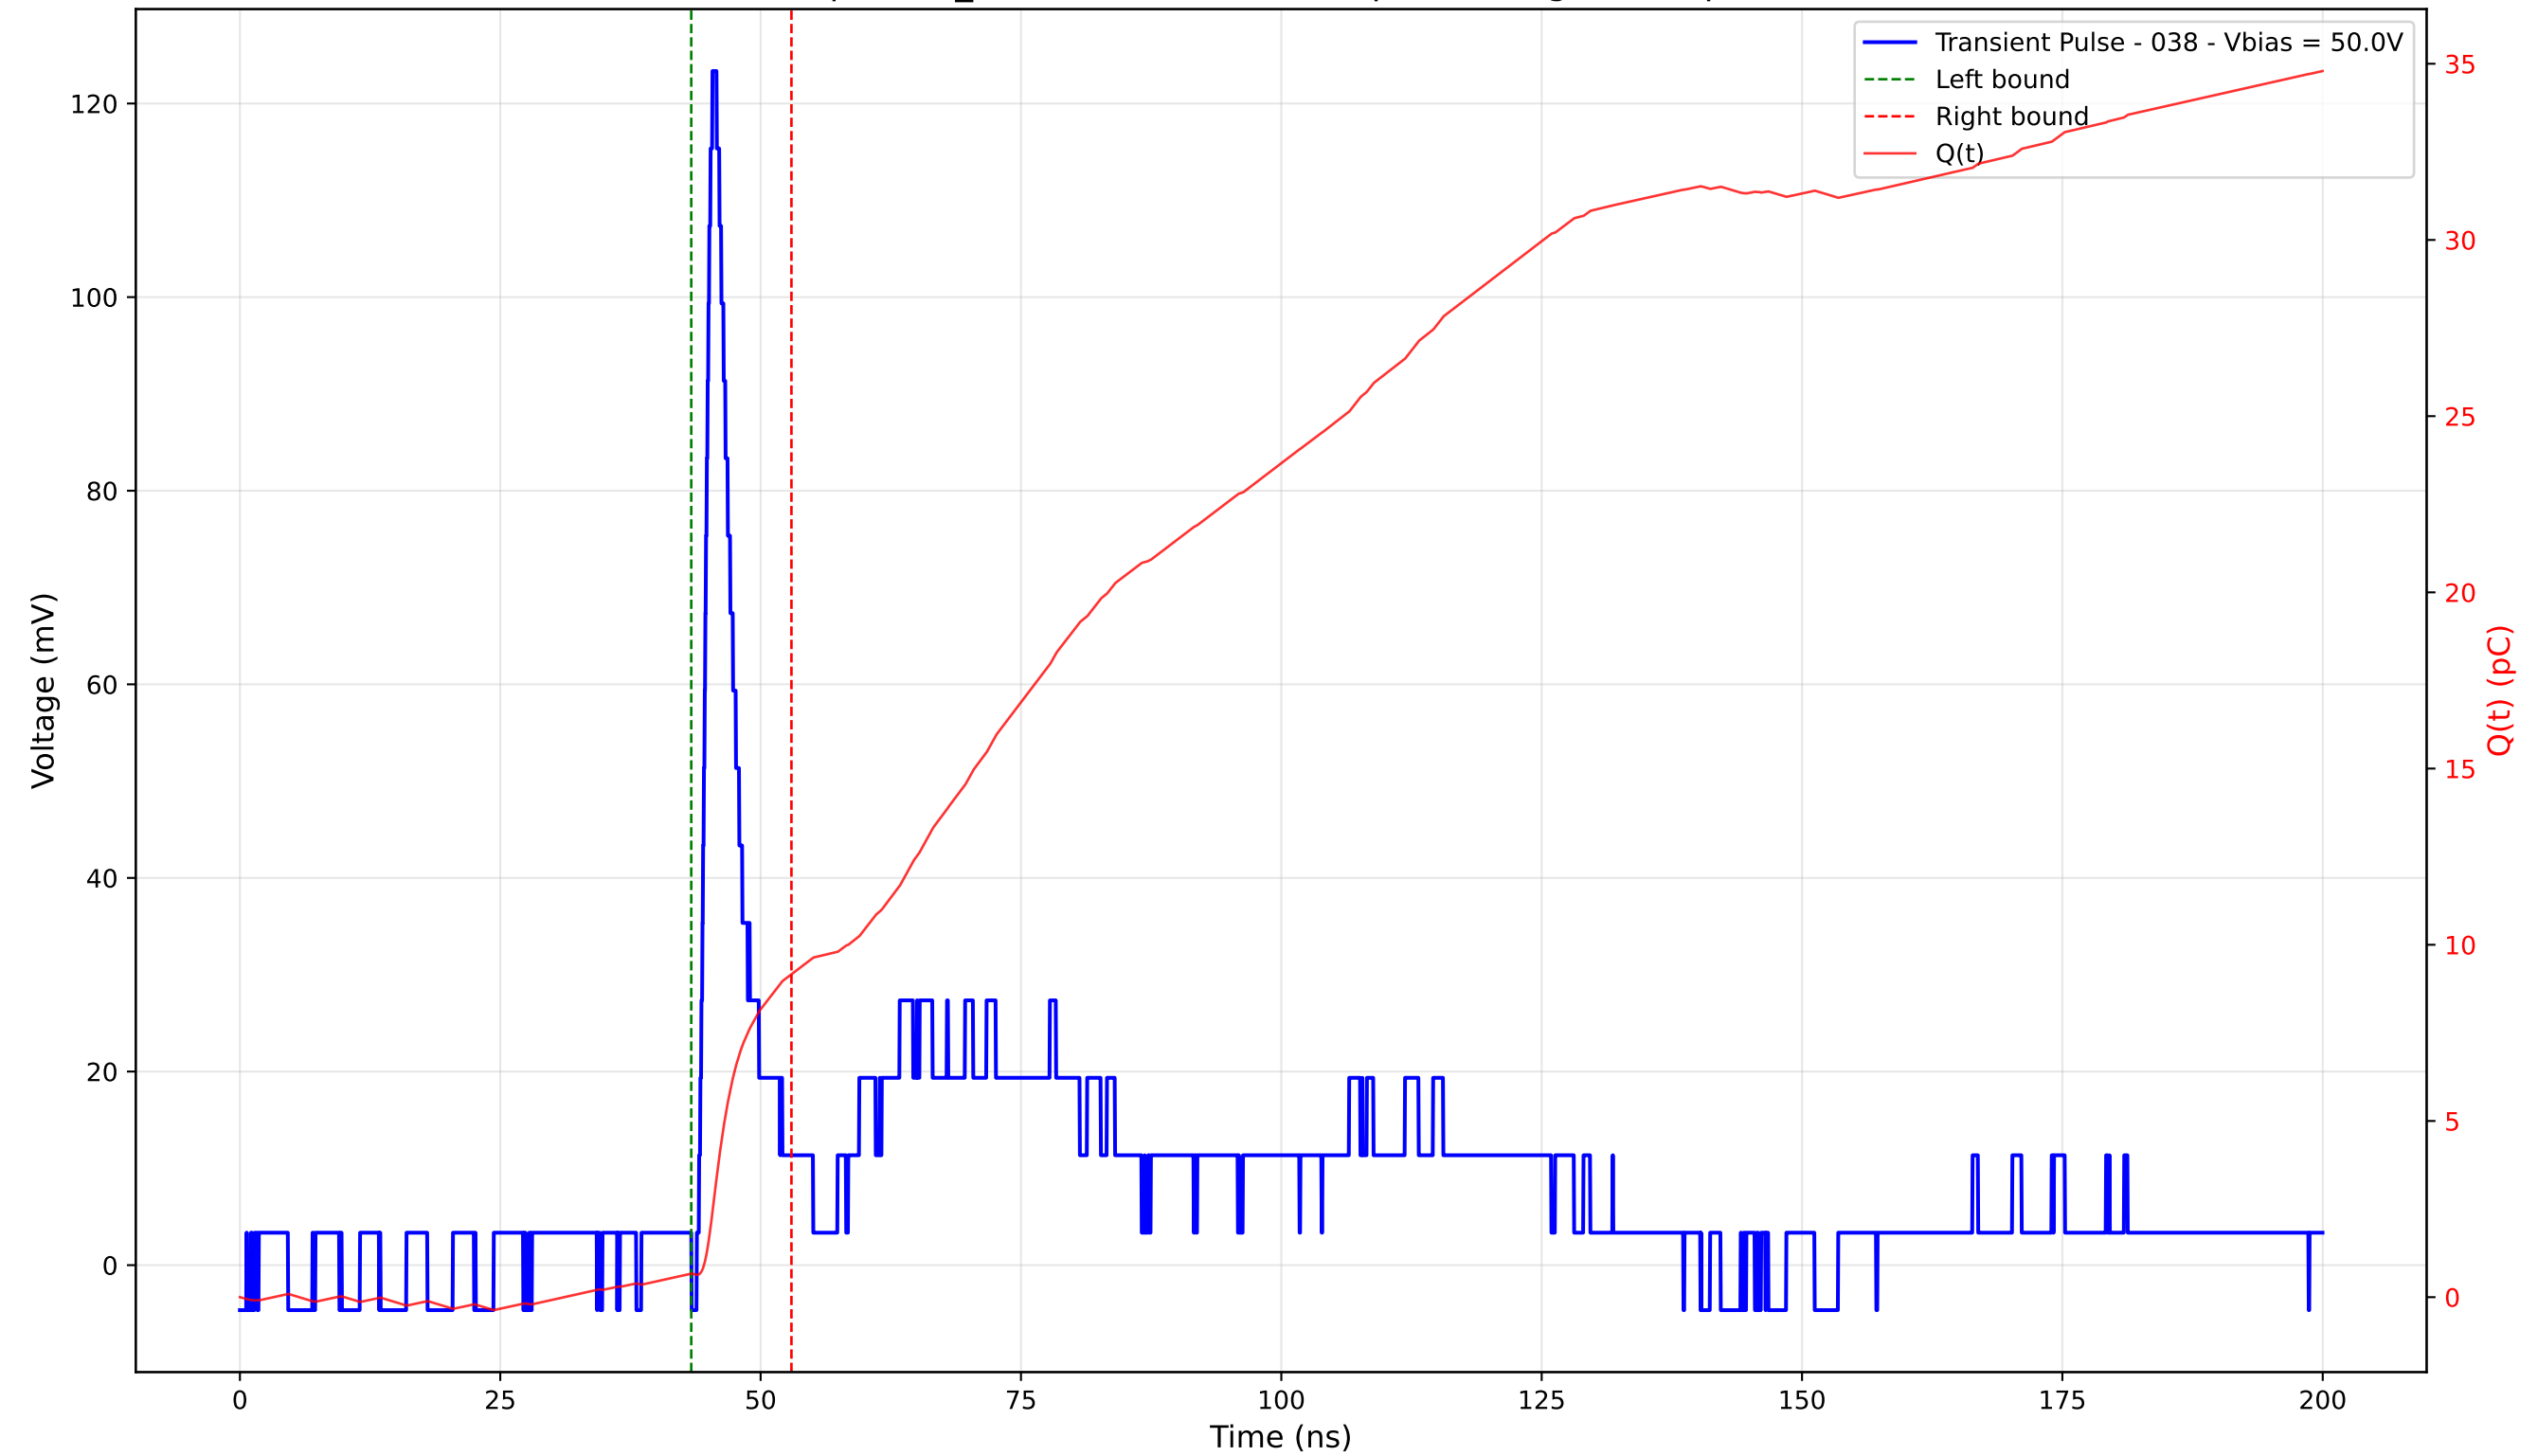


Transient Pulse - Sample: TD_4004 - Position: 390.0 μm - Charge: 7.12 pC - Rise Time: 1.00 ns

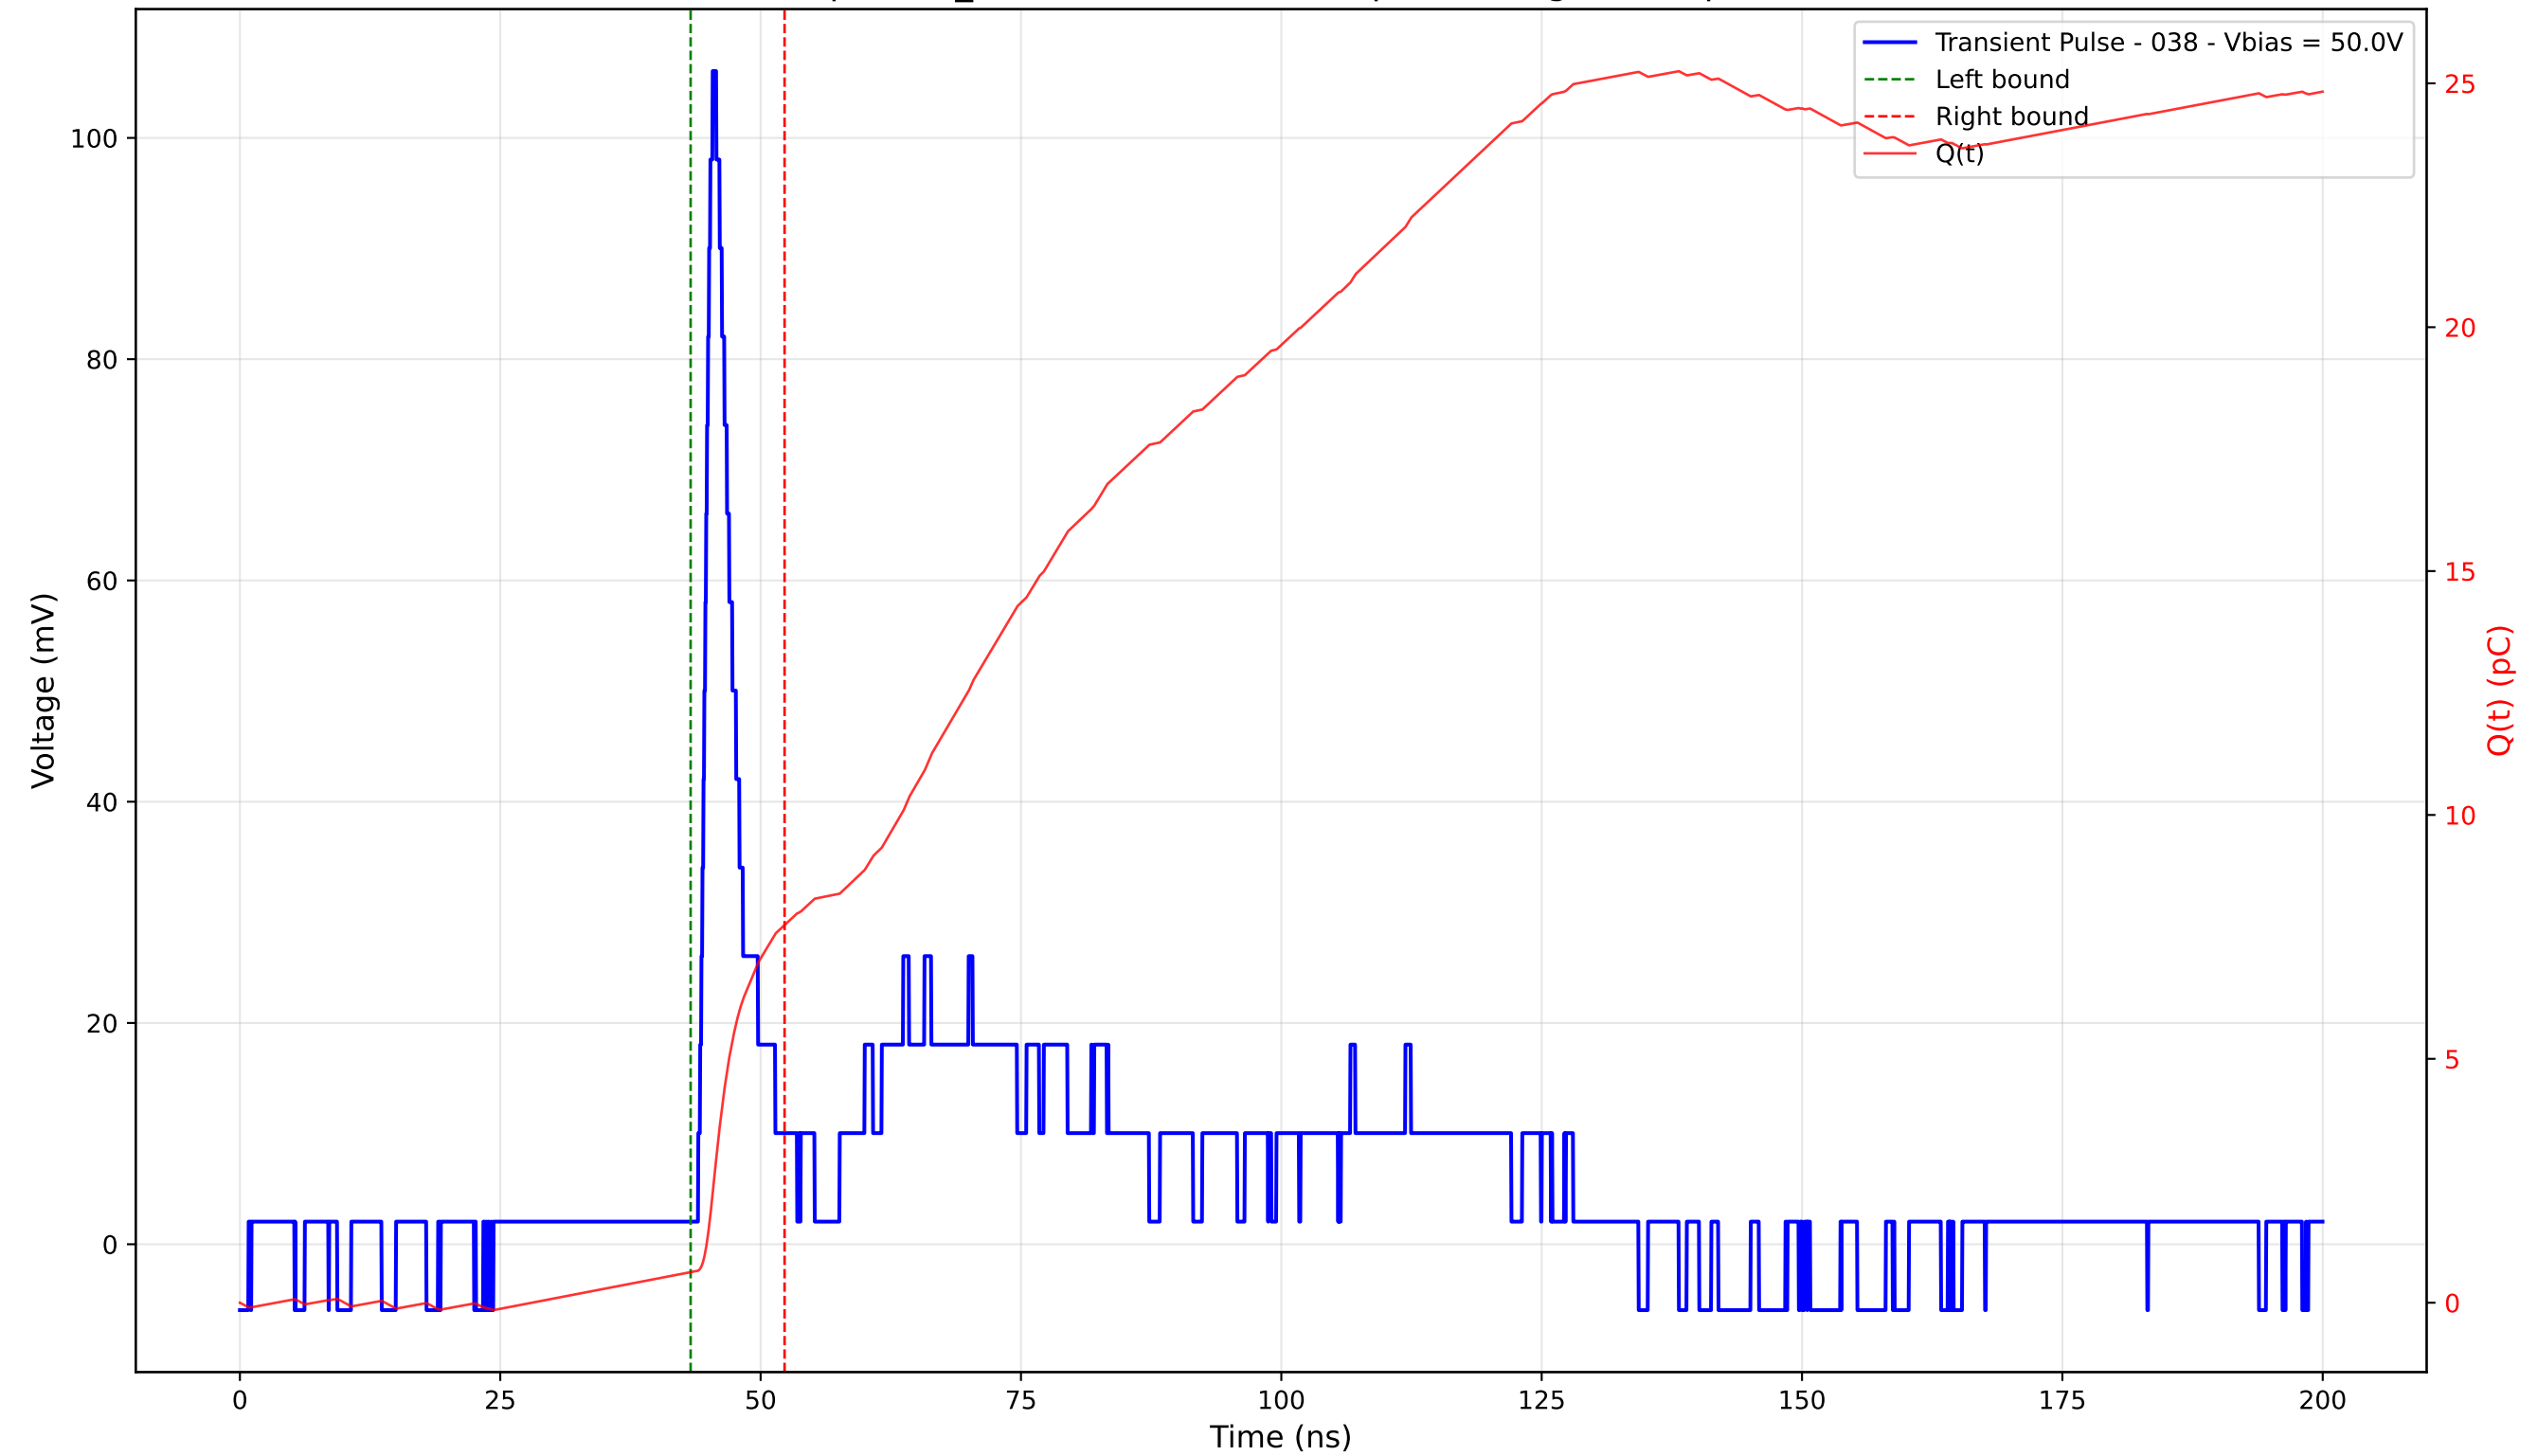


Transient Pulse - Sample: TD_4004 - Position: 395.0 μm - Charge: 6.36 pC - Rise Time: 0.95 ns

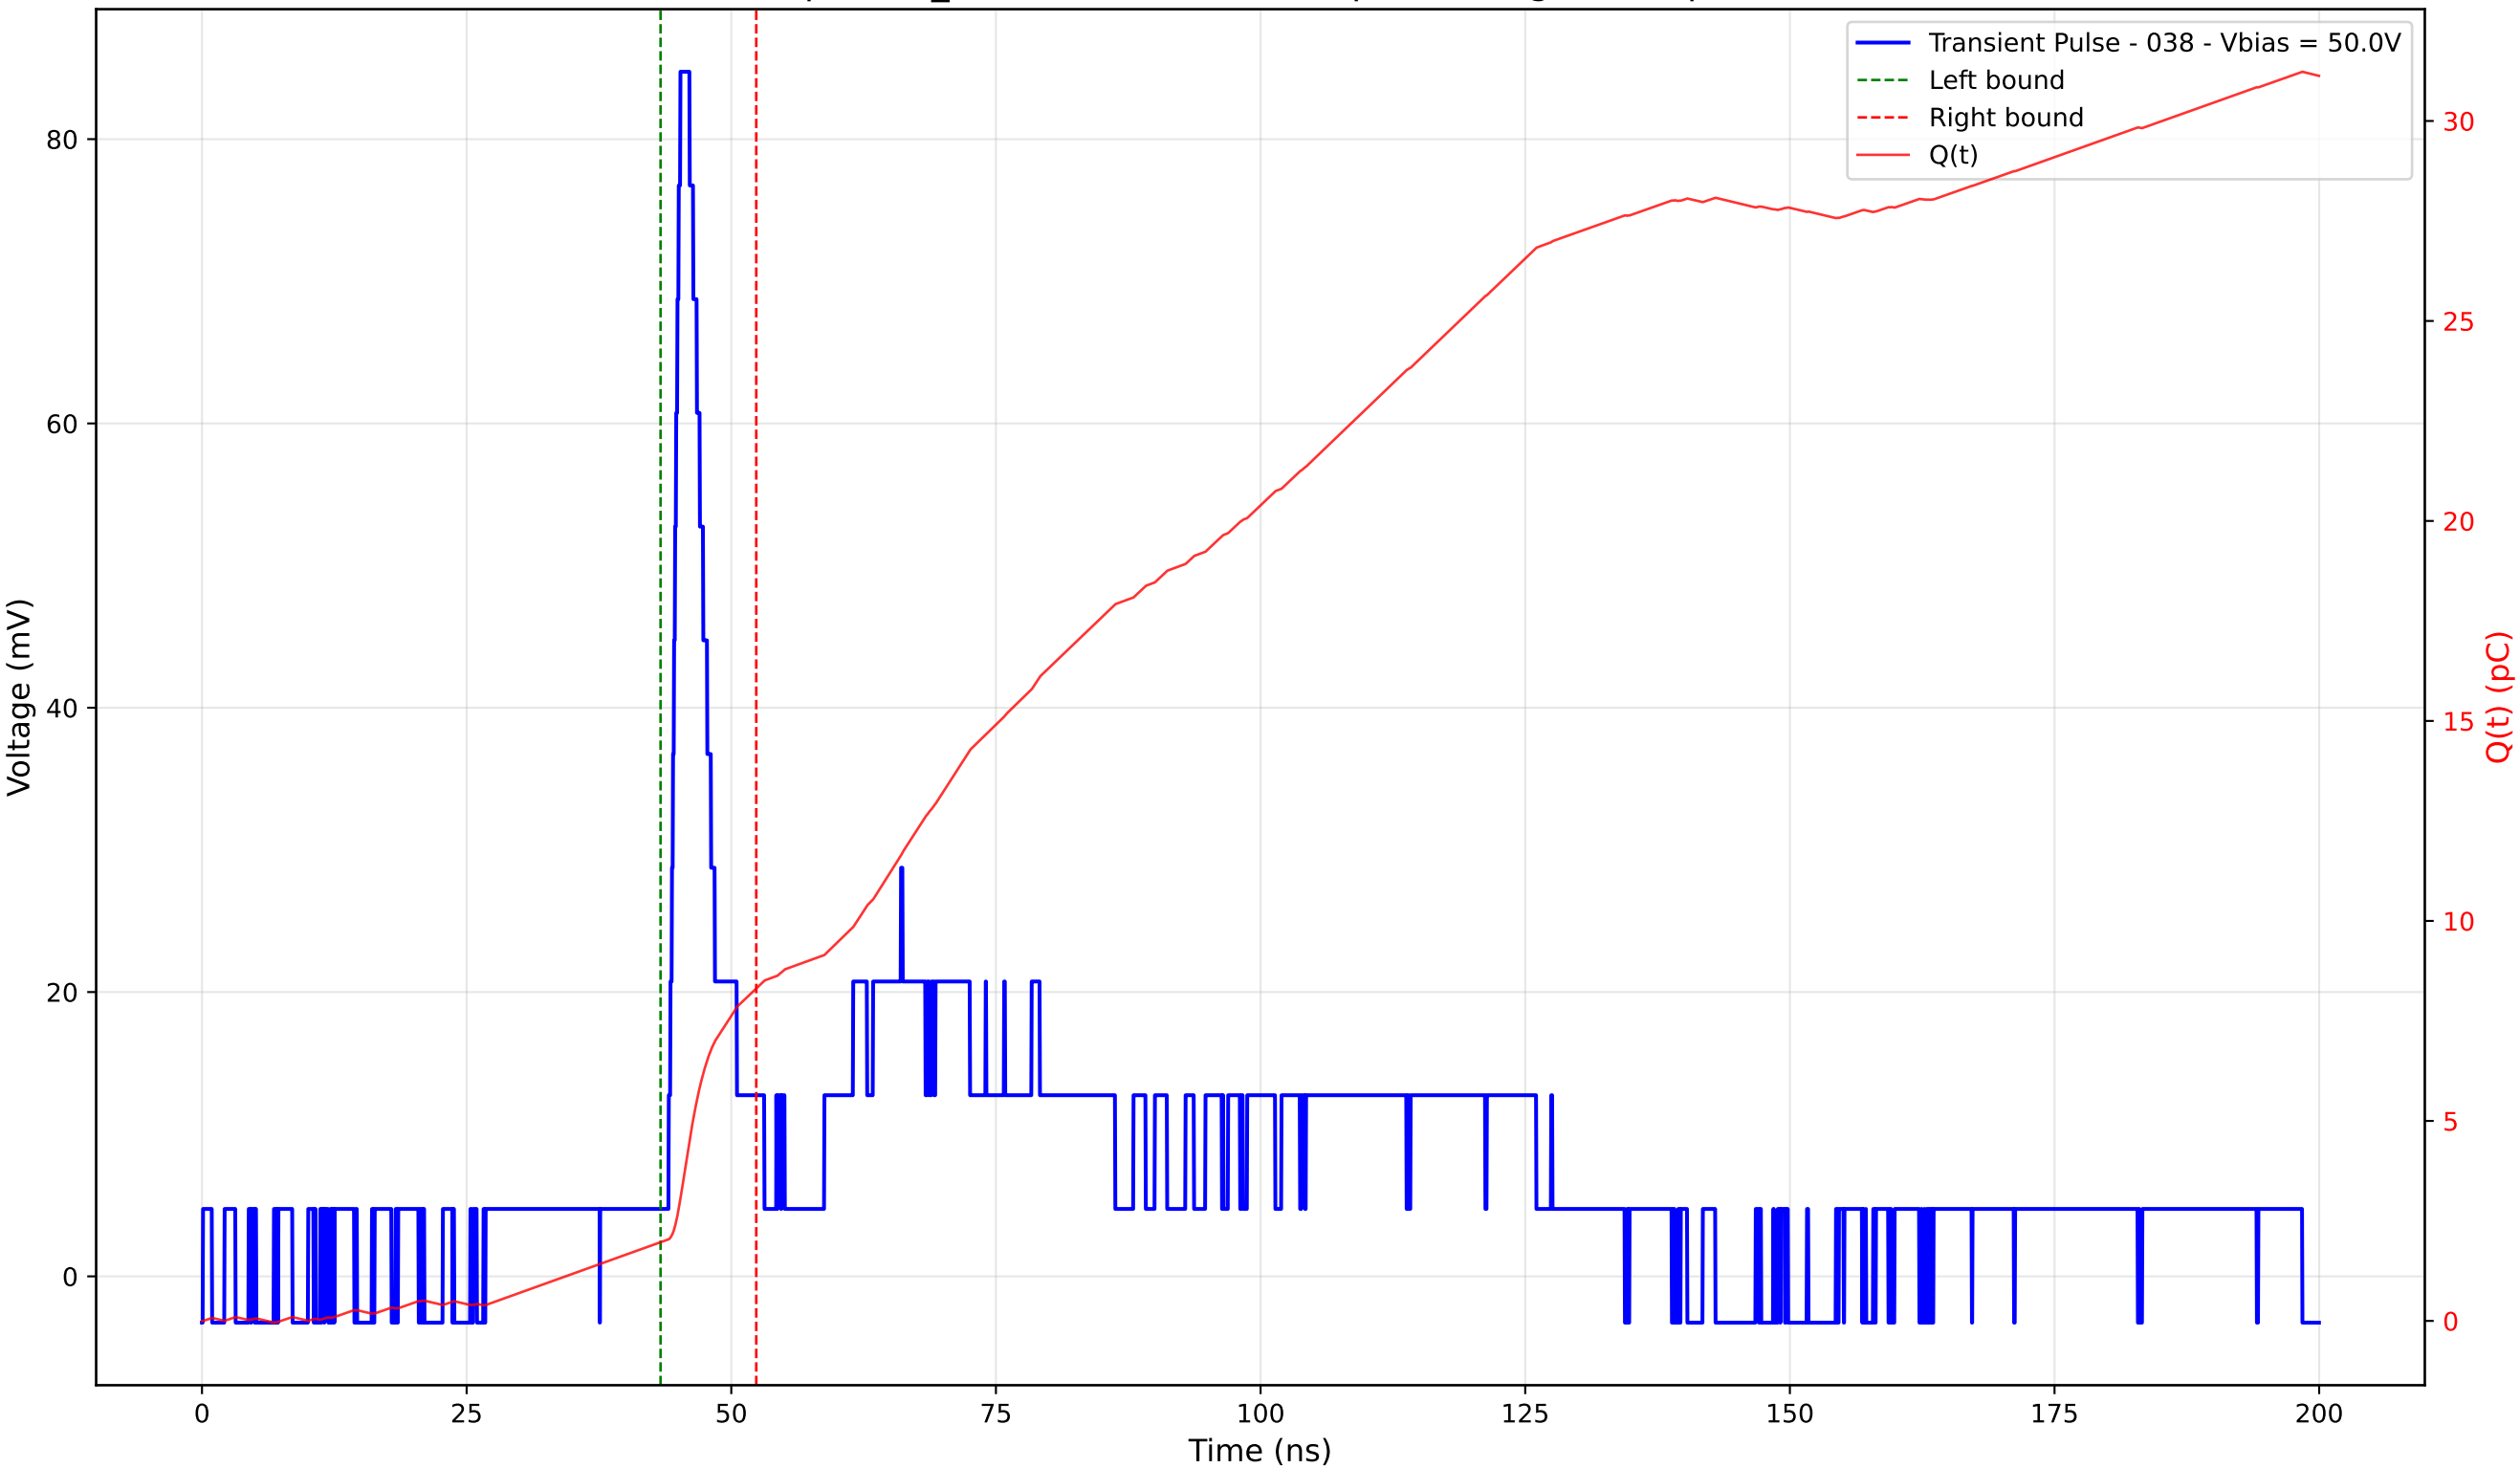


Transient Pulse - Sample: TD_4004 - Position: 400.0 μm - Charge: 4.83 pC - Rise Time: 1.42 ns

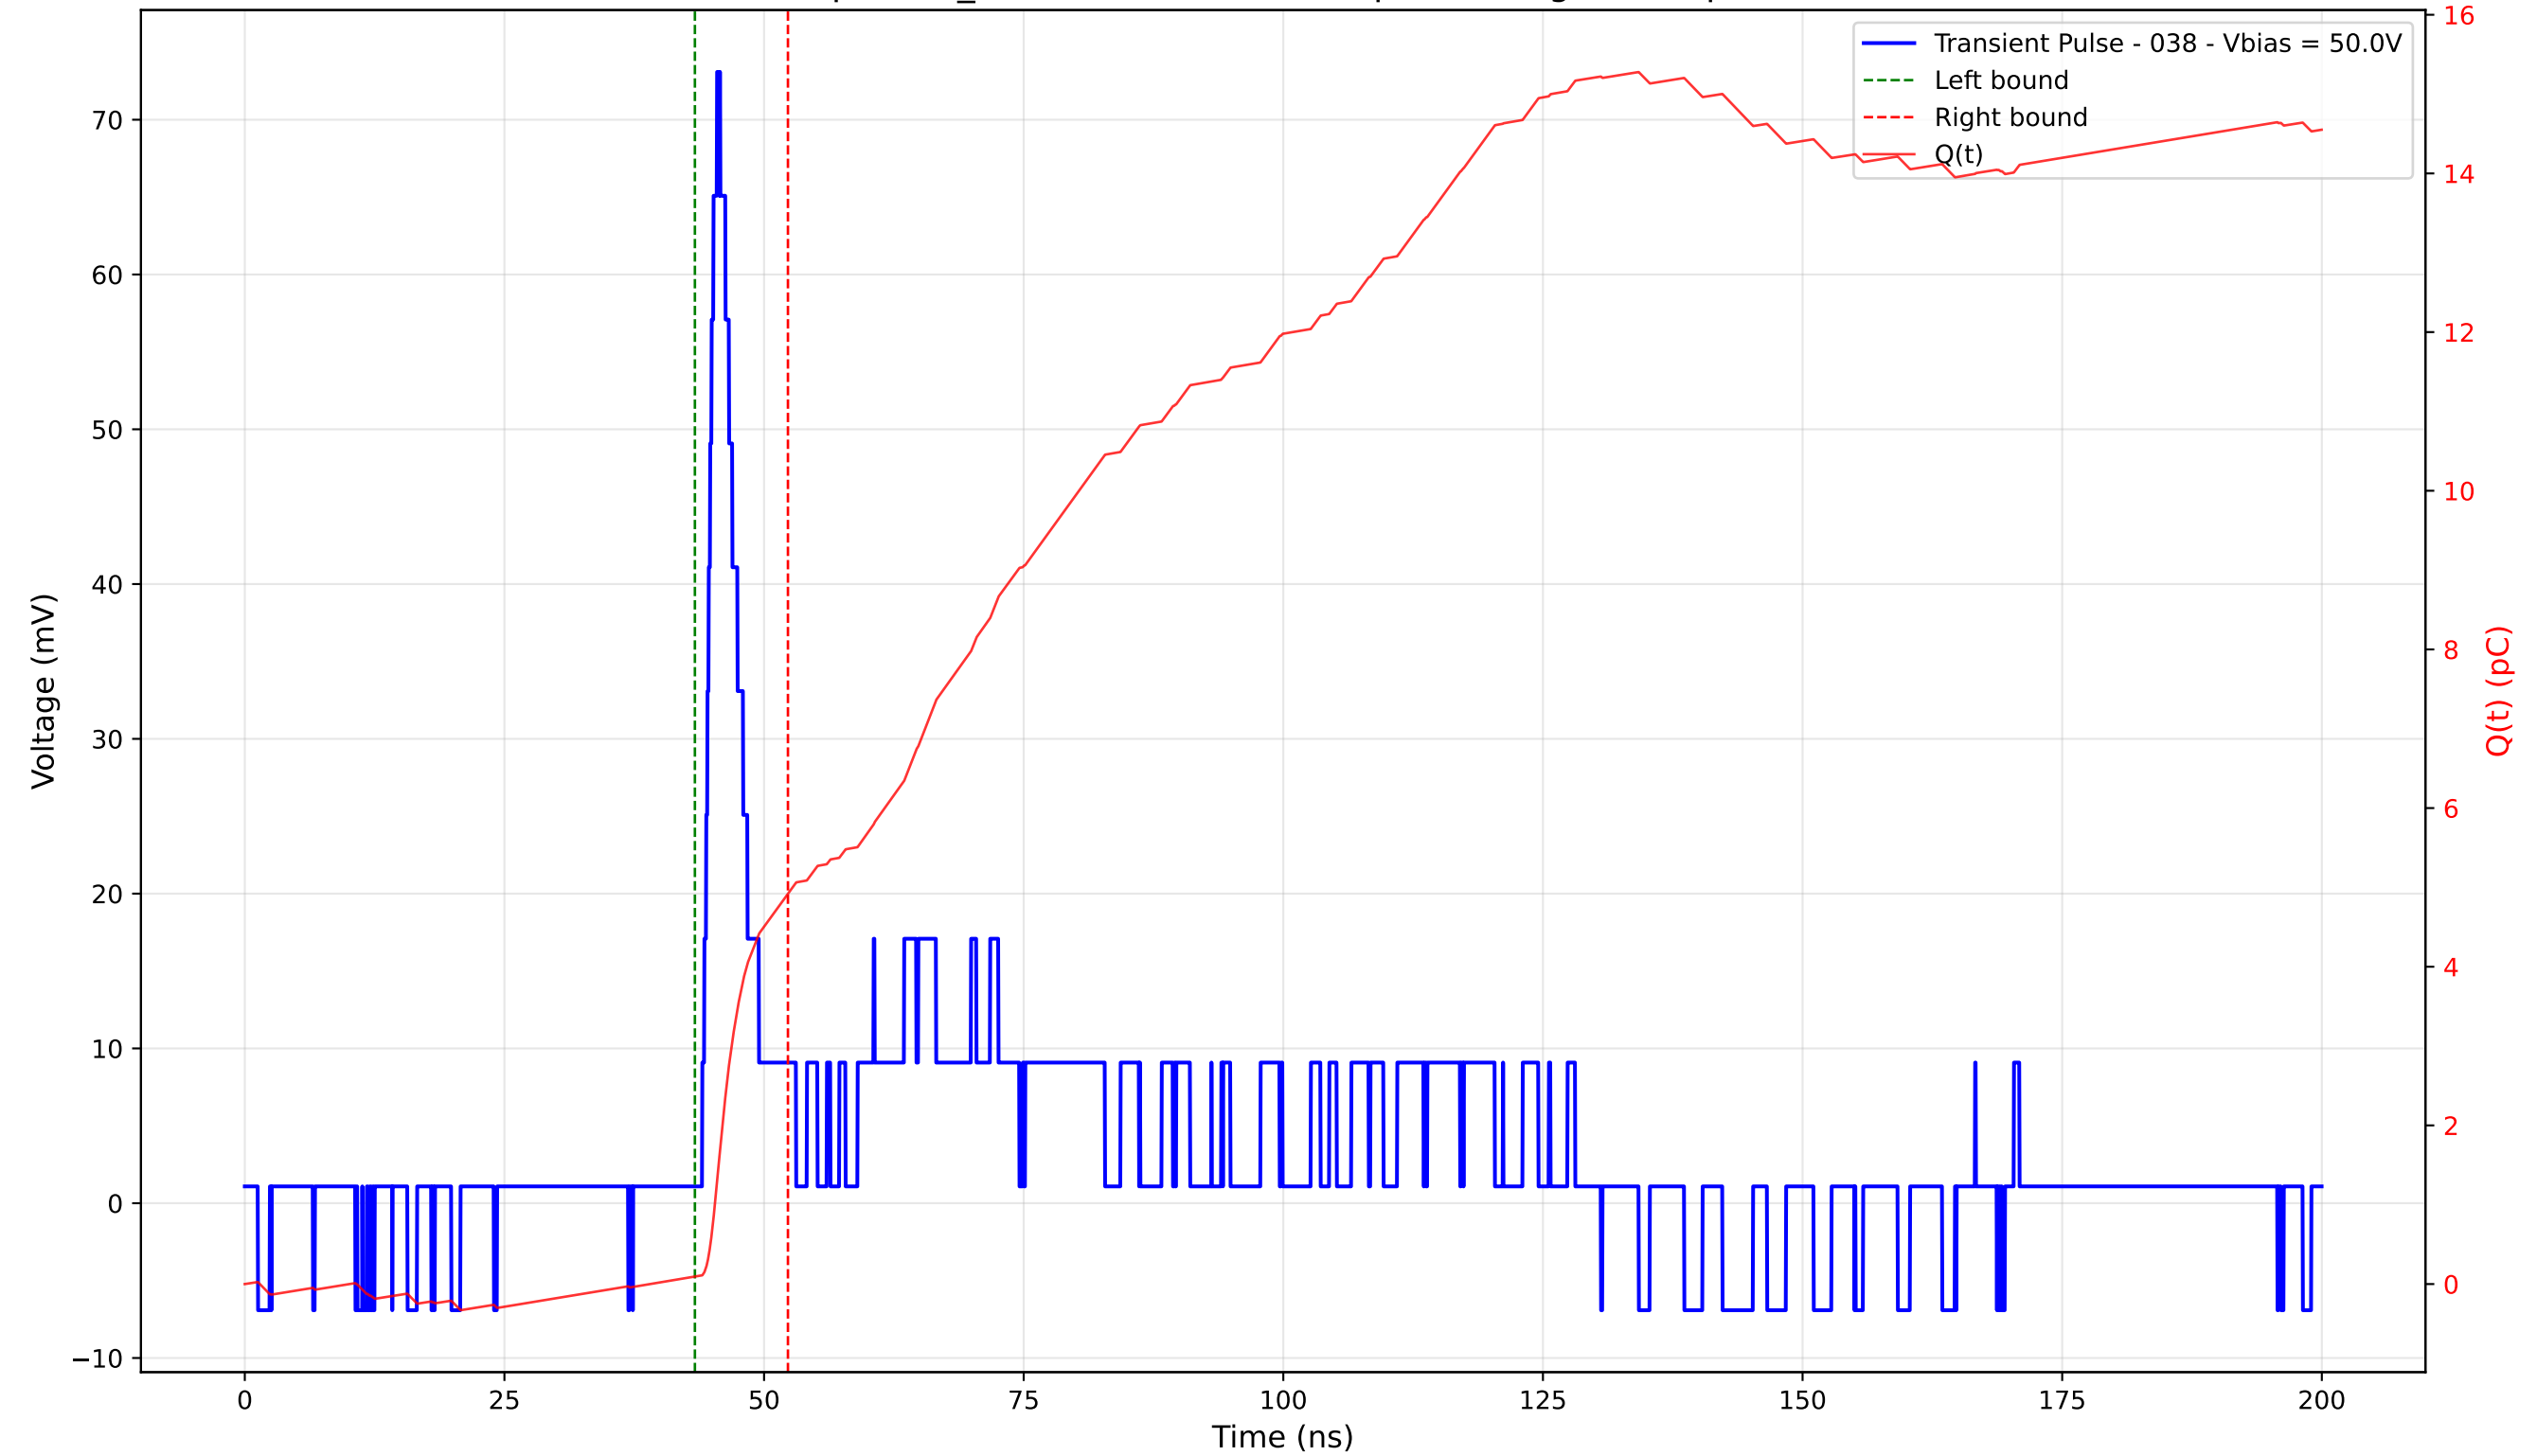


Transient Pulse - Sample: TD_4004 - Position: 405.0 μm - Charge: 4.03 pC - Rise Time: 1.07 ns

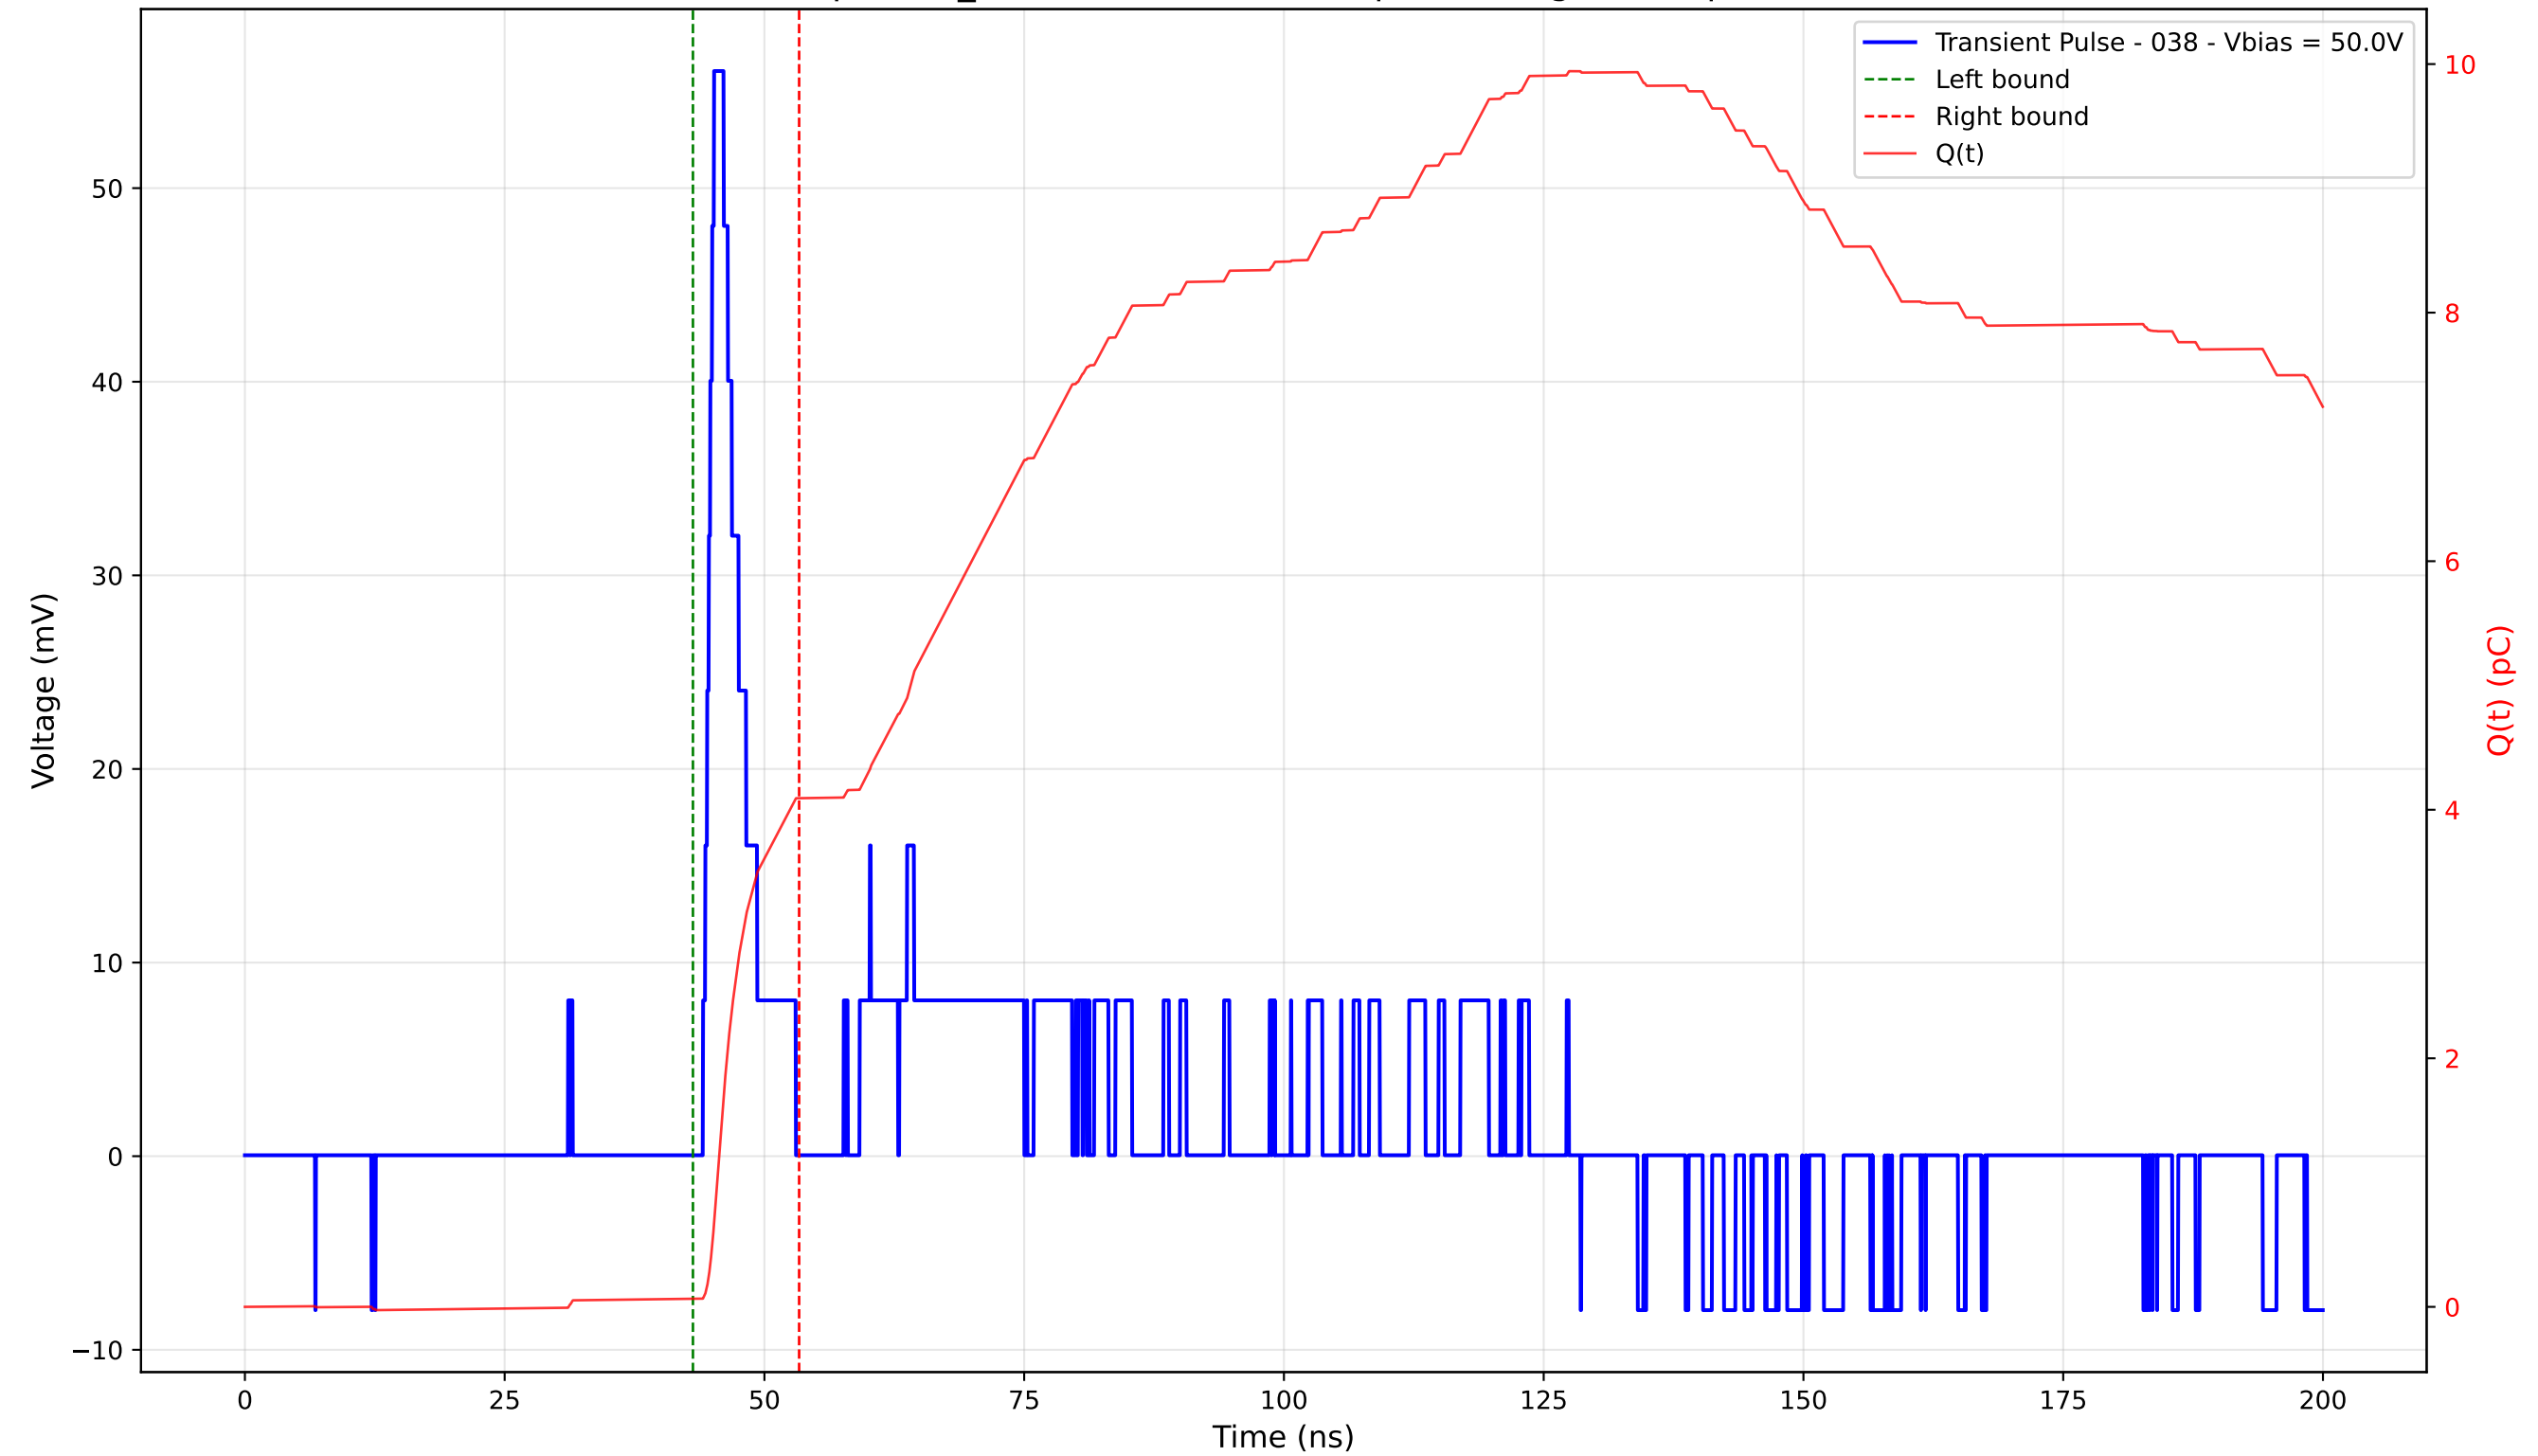


Transient Pulse - Sample: TD_4004 - Position: 410.0 μm - Charge: 4.54 pC - Rise Time: 6.54 ns

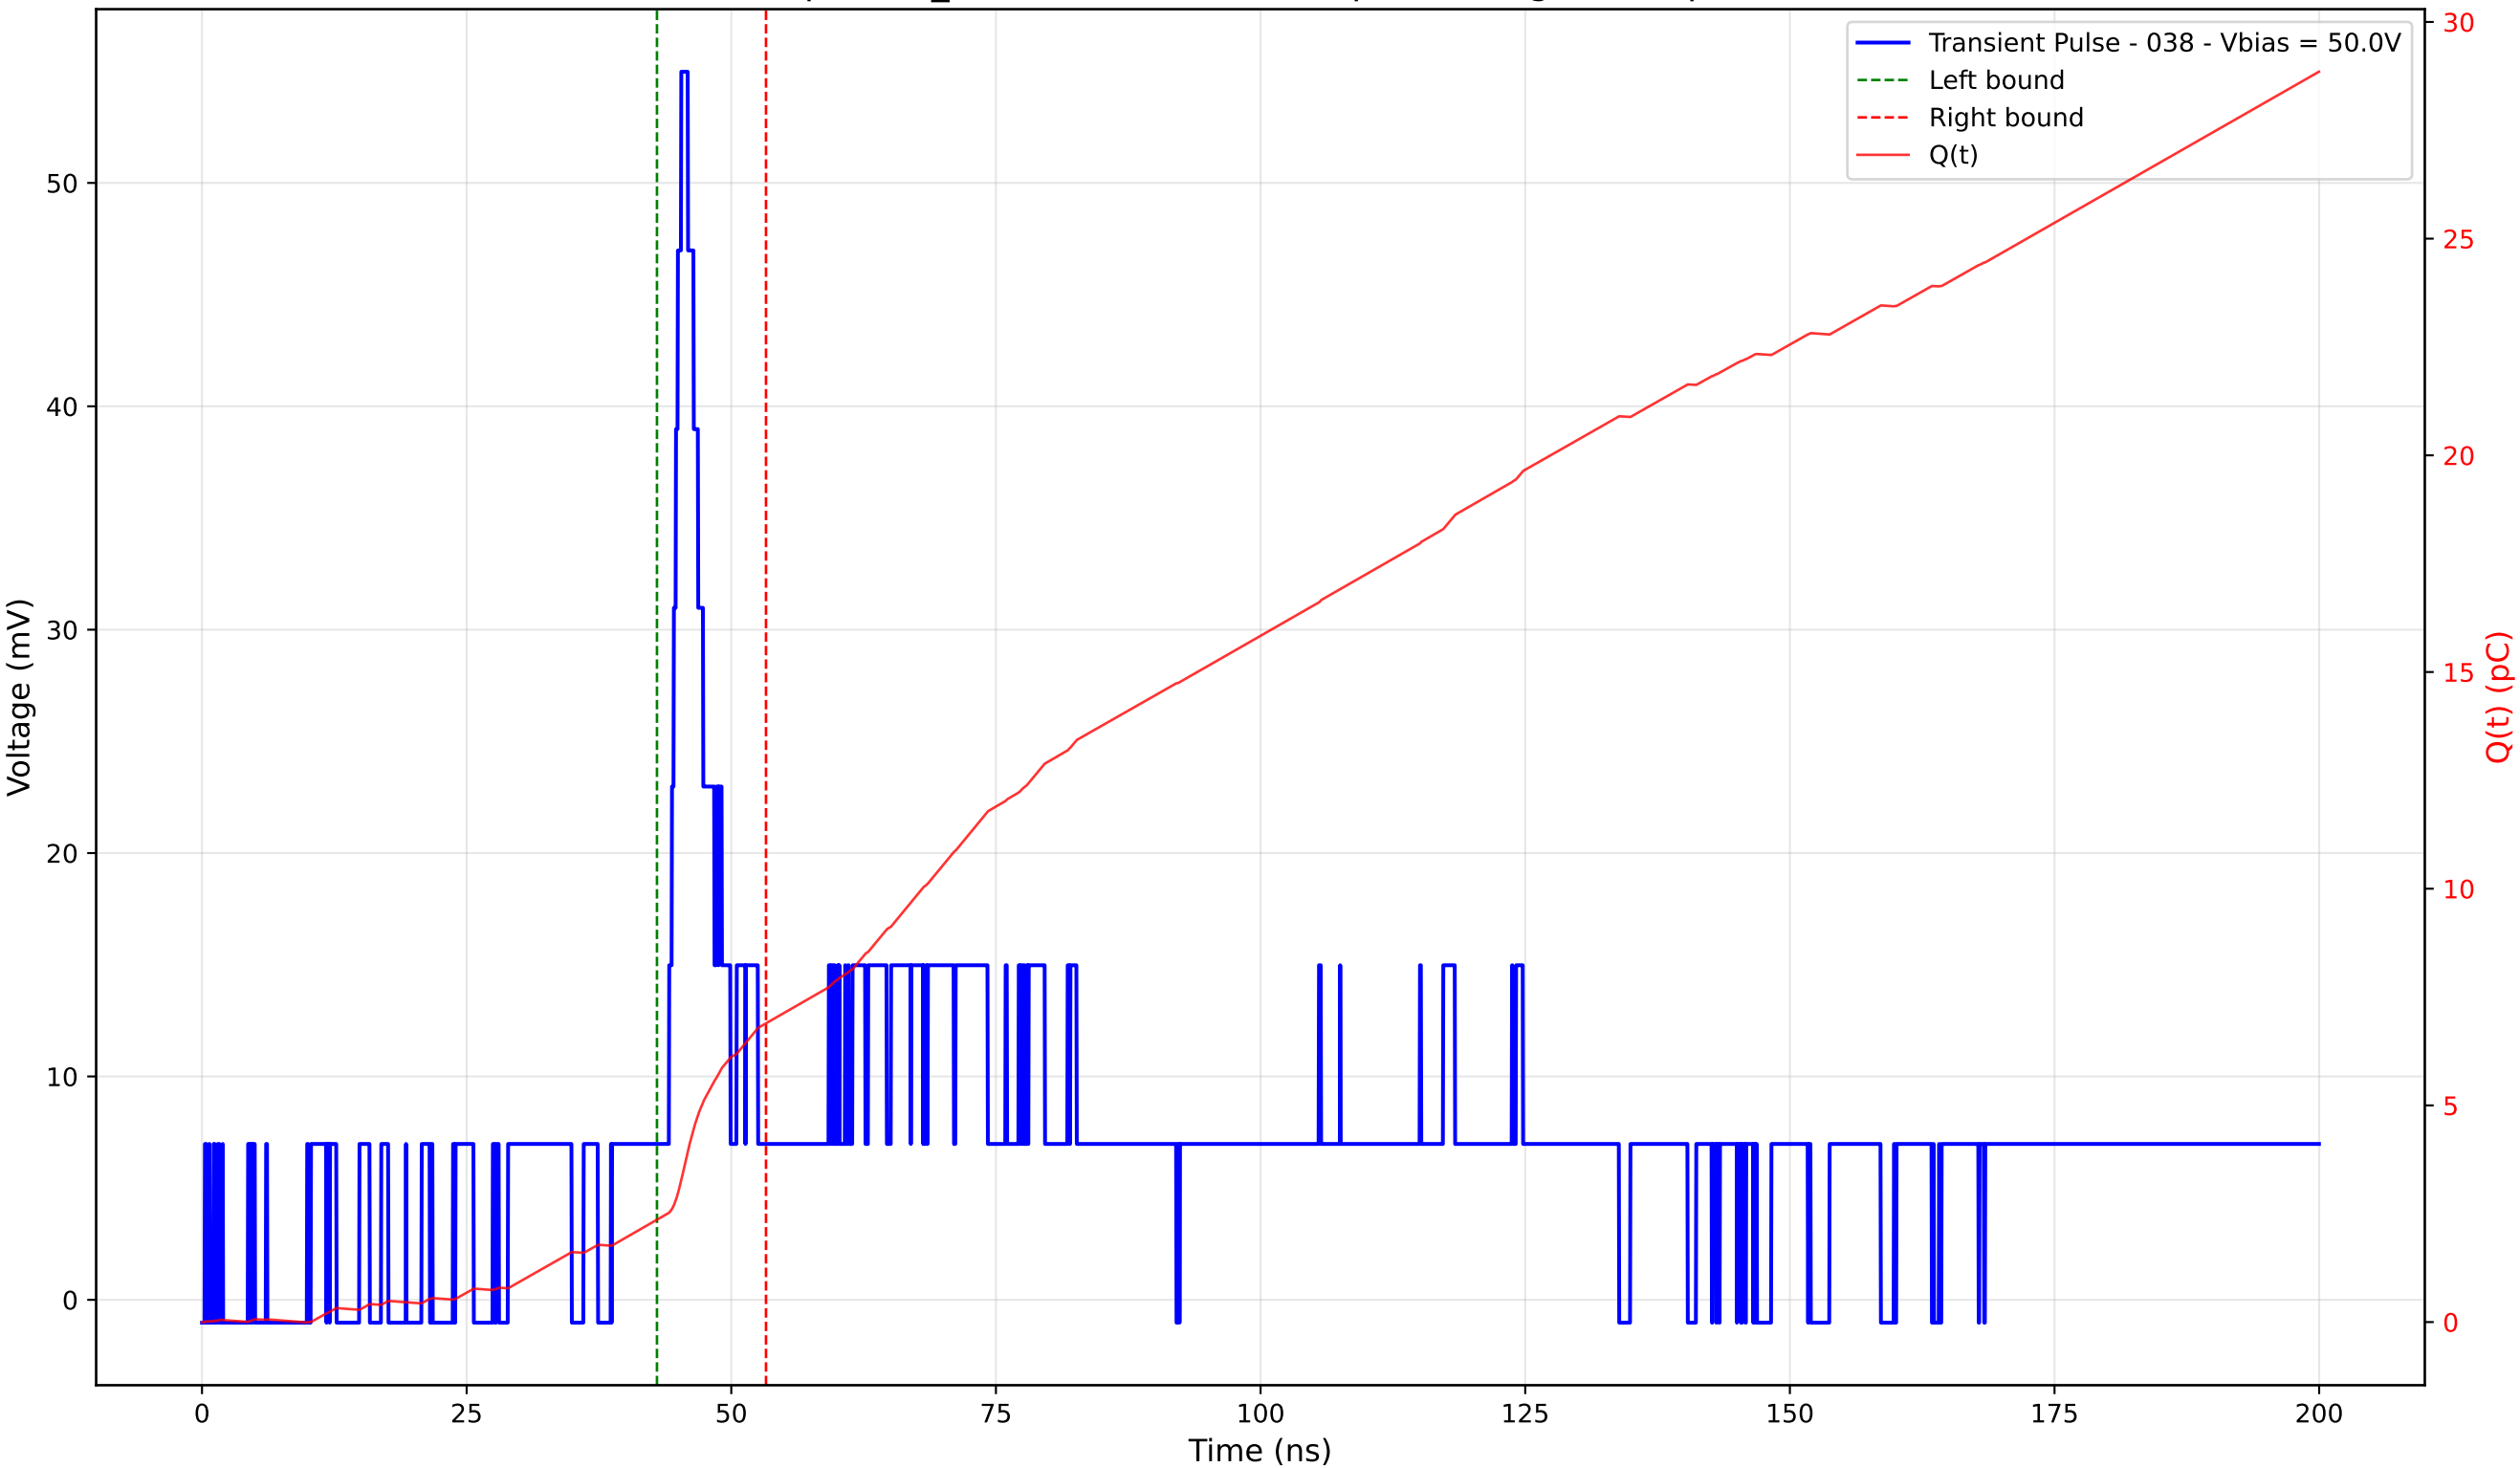


Transient Pulse - Sample: TD_4004 - Position: 415.0 μm - Charge: 2.72 pC - Rise Time: 1.47 ns

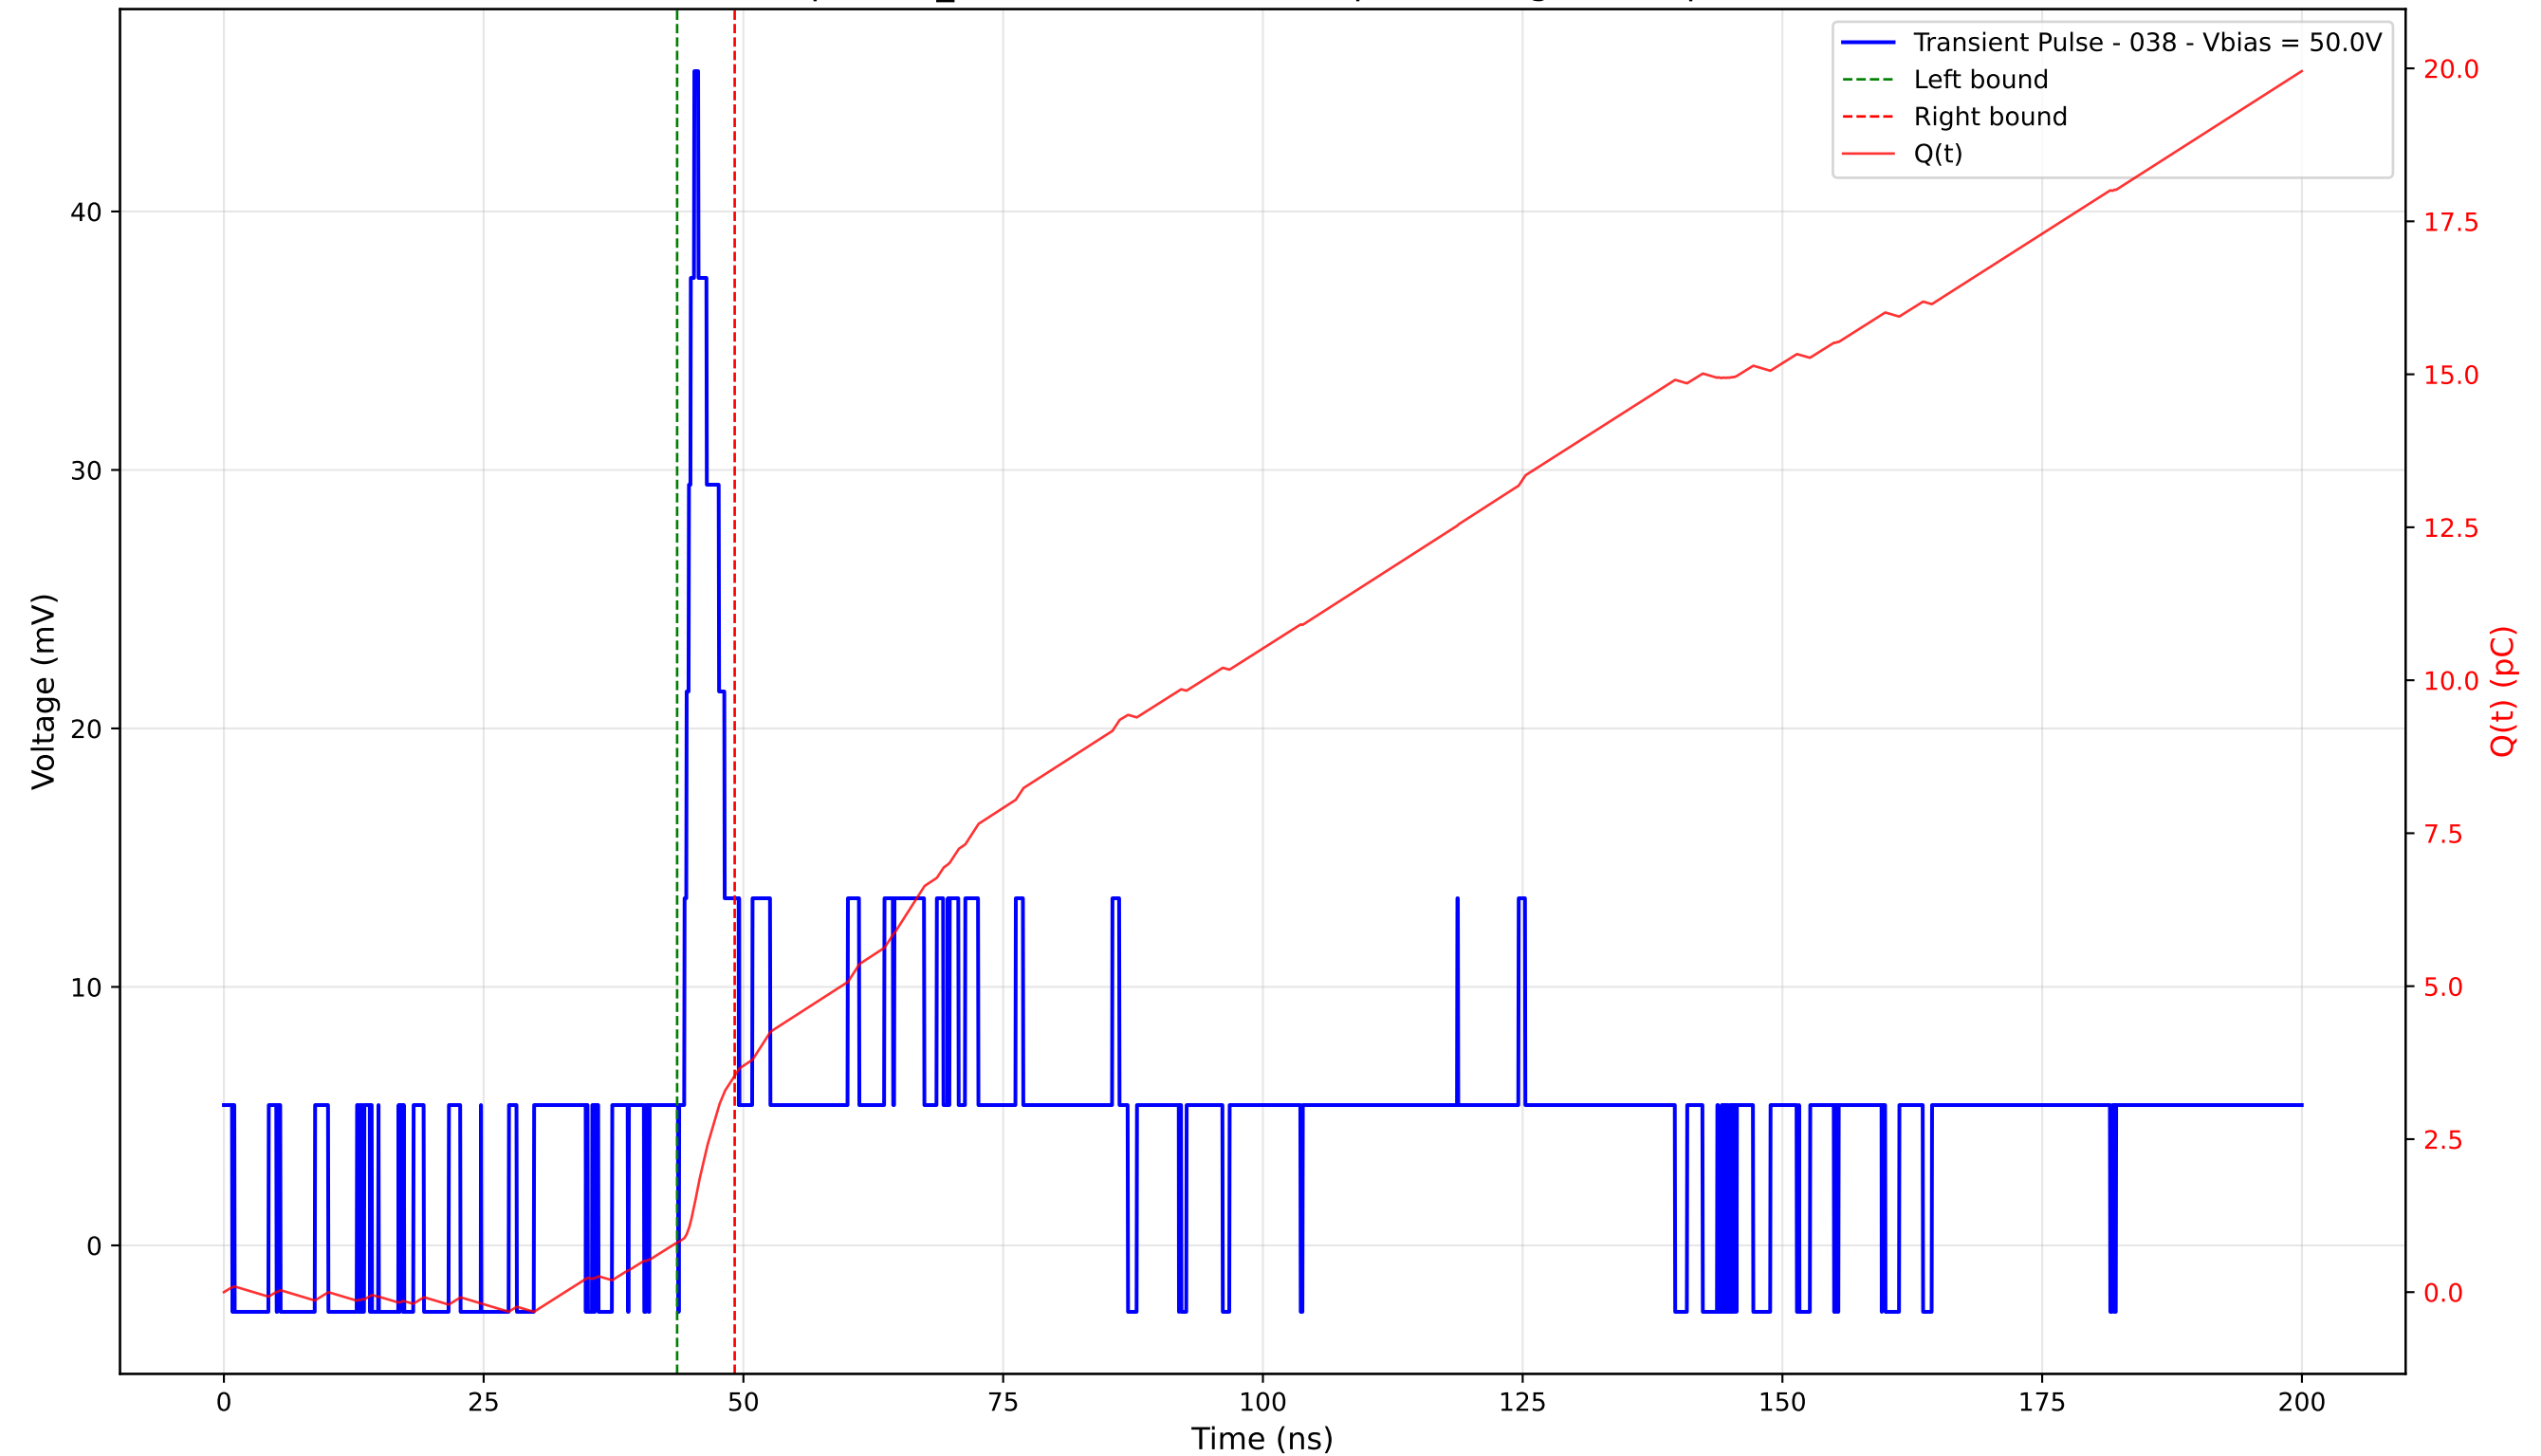


Transient Pulse - Sample: TD_4004 - Position: 420.0 μm - Charge: 1.79 pC - Rise Time: 0.72 ns

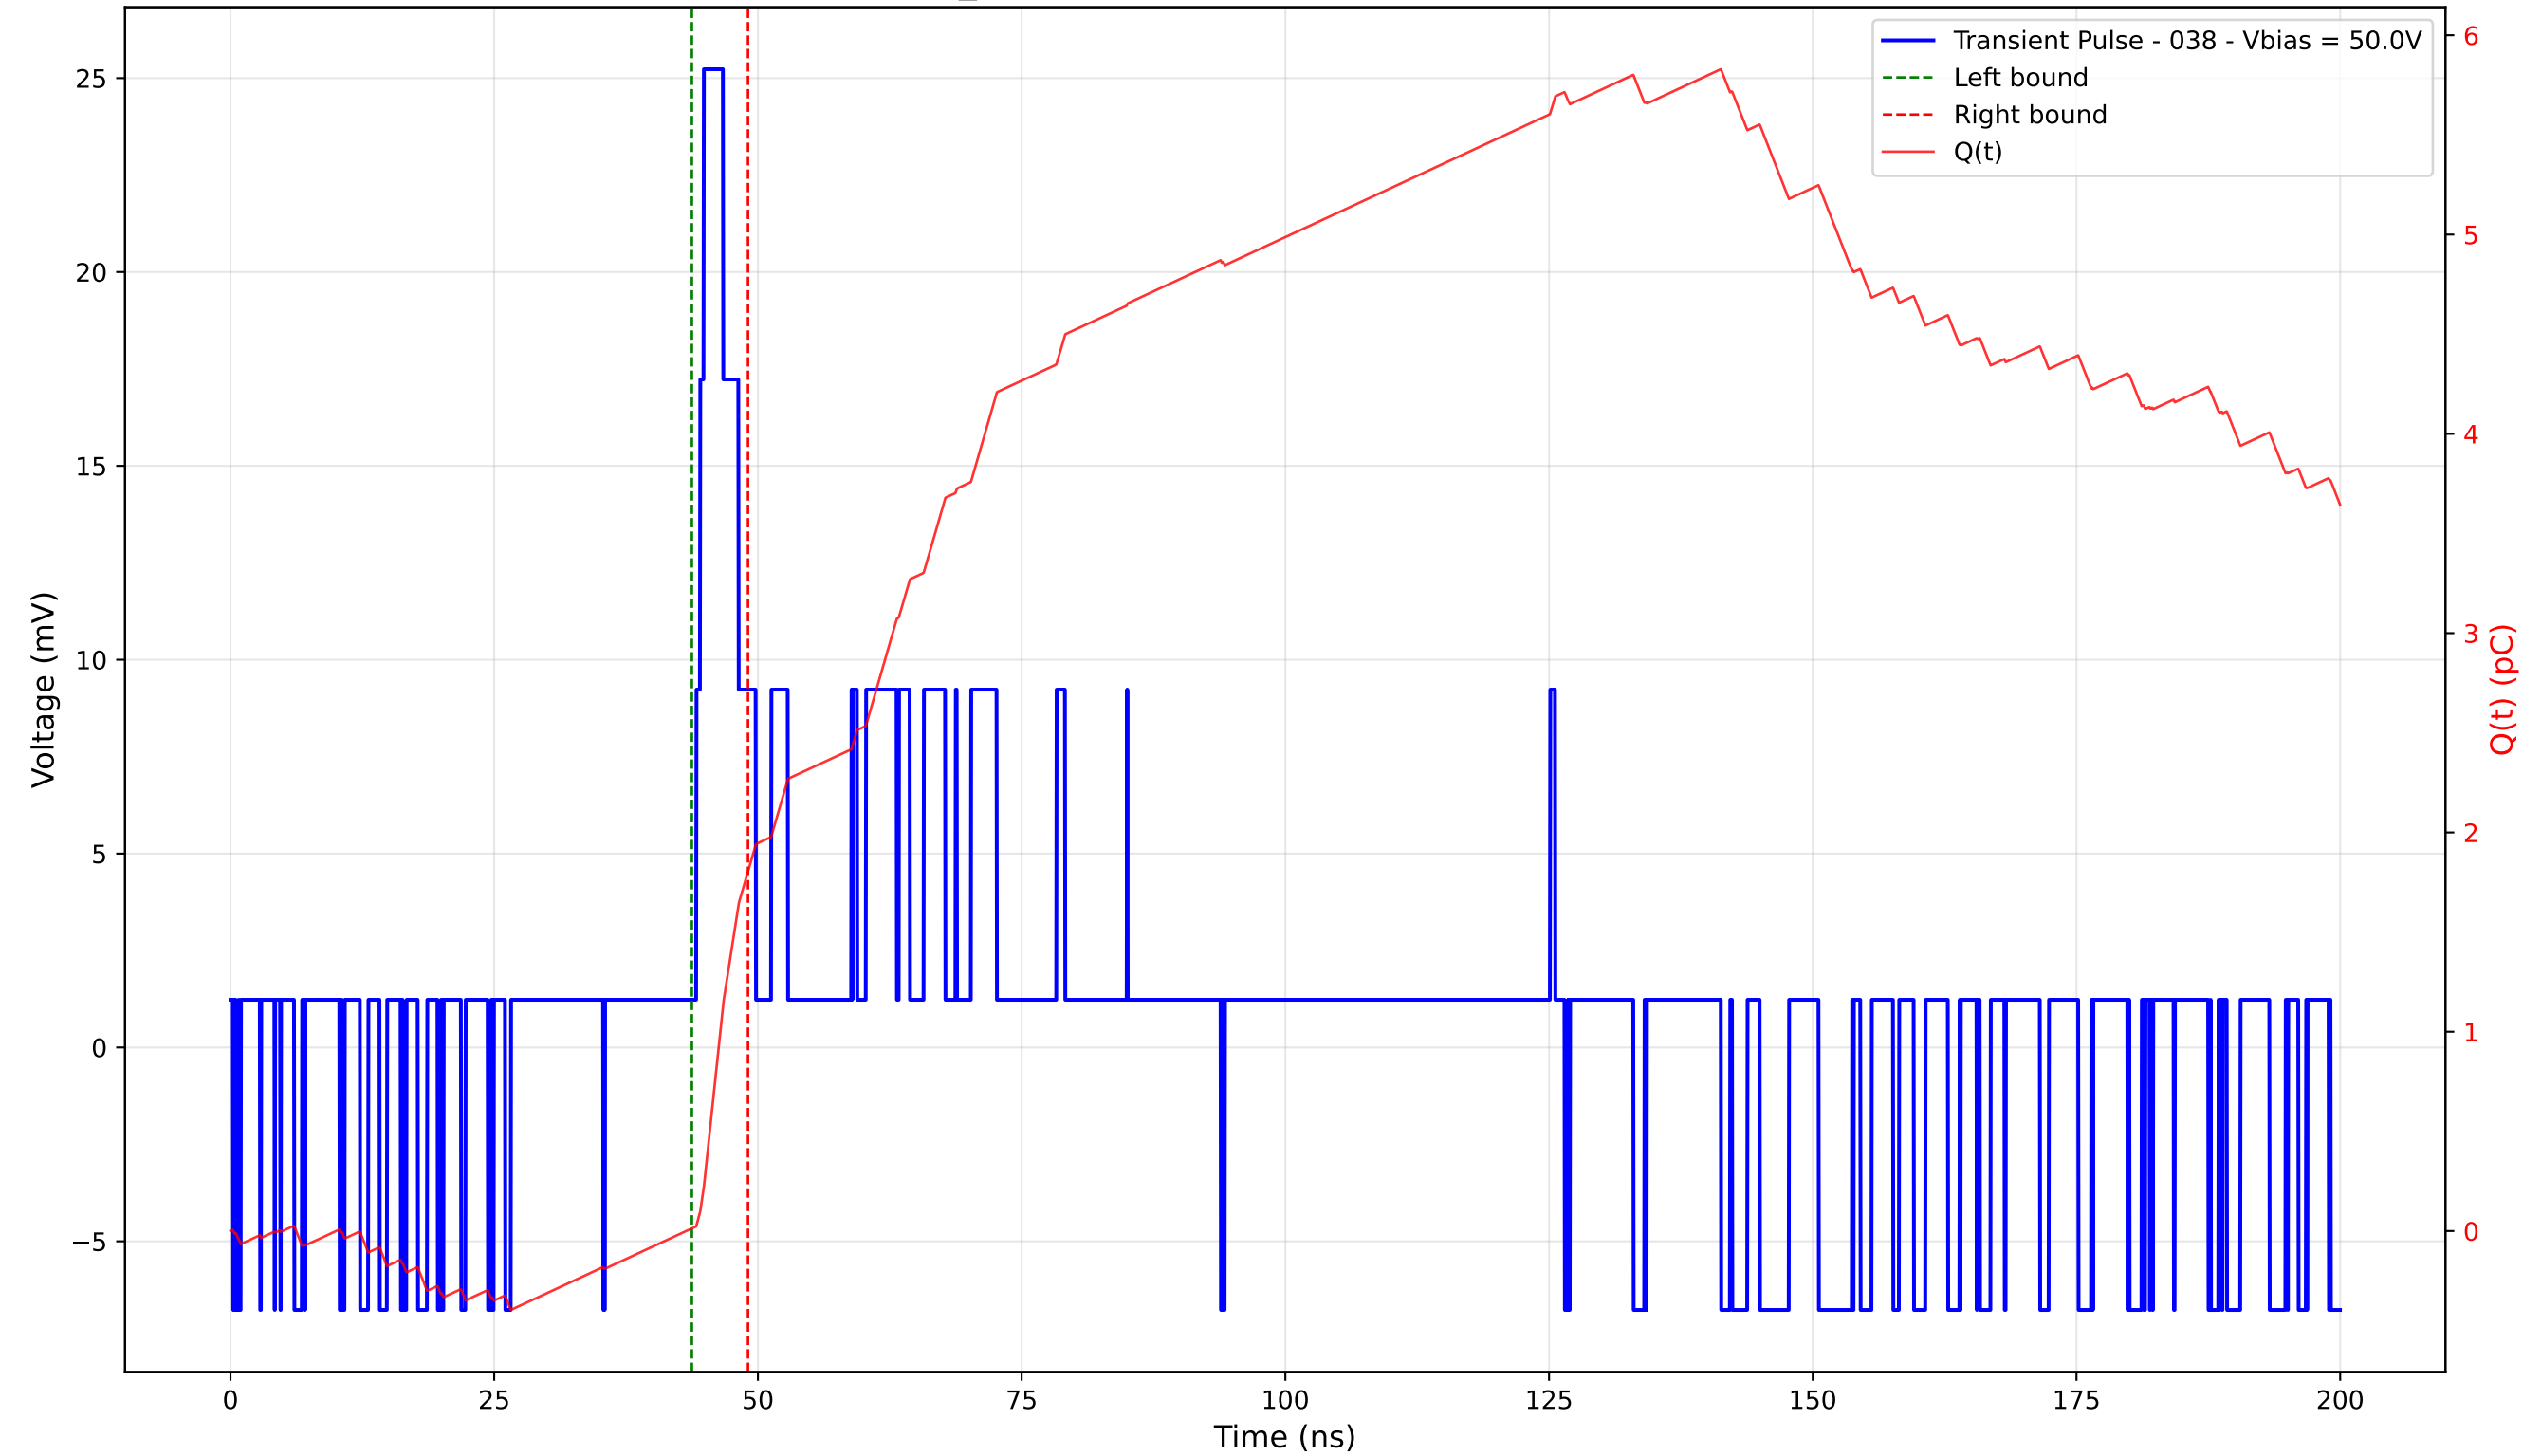

Transient Pulse - Sample: TD_4004 - Position: 425.0 μm - Charge: 1.35 pC - Rise Time: 1.60 ns

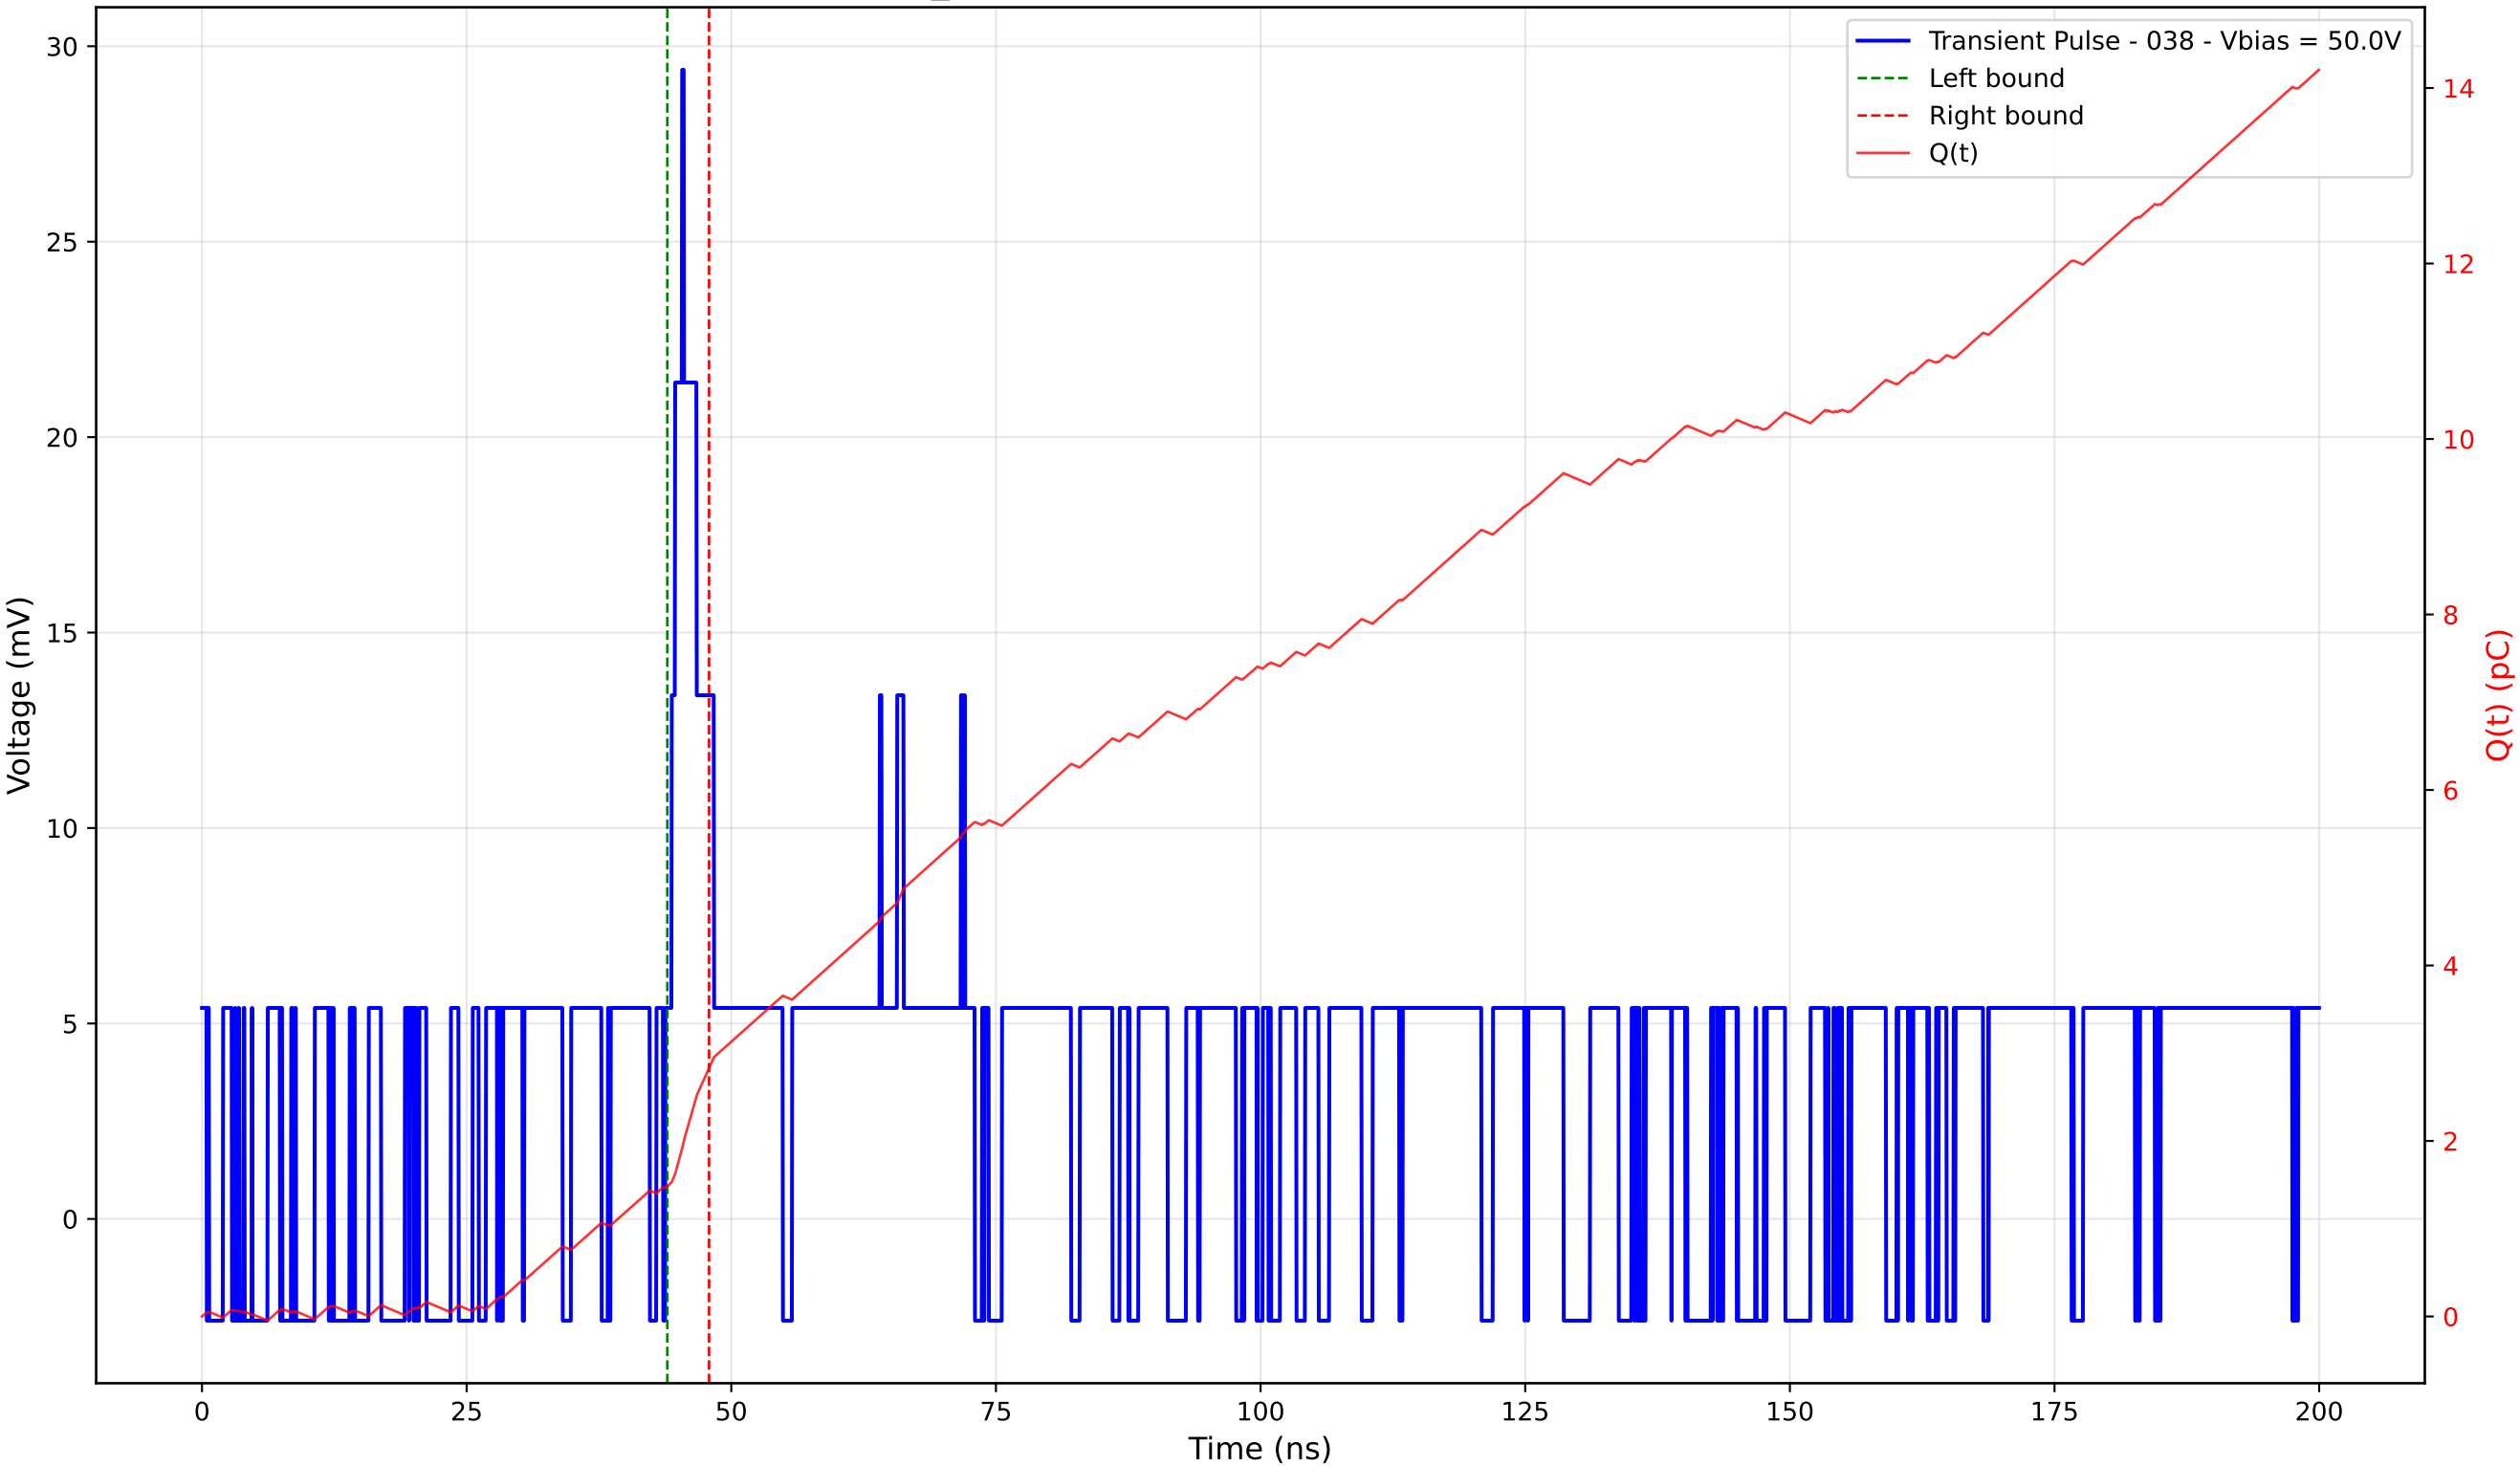

Transient Pulse - Sample: TD_4004 - Position: 430.0 μm - Charge: 5.28 pC - Rise Time: 0.00 ns (N/A)

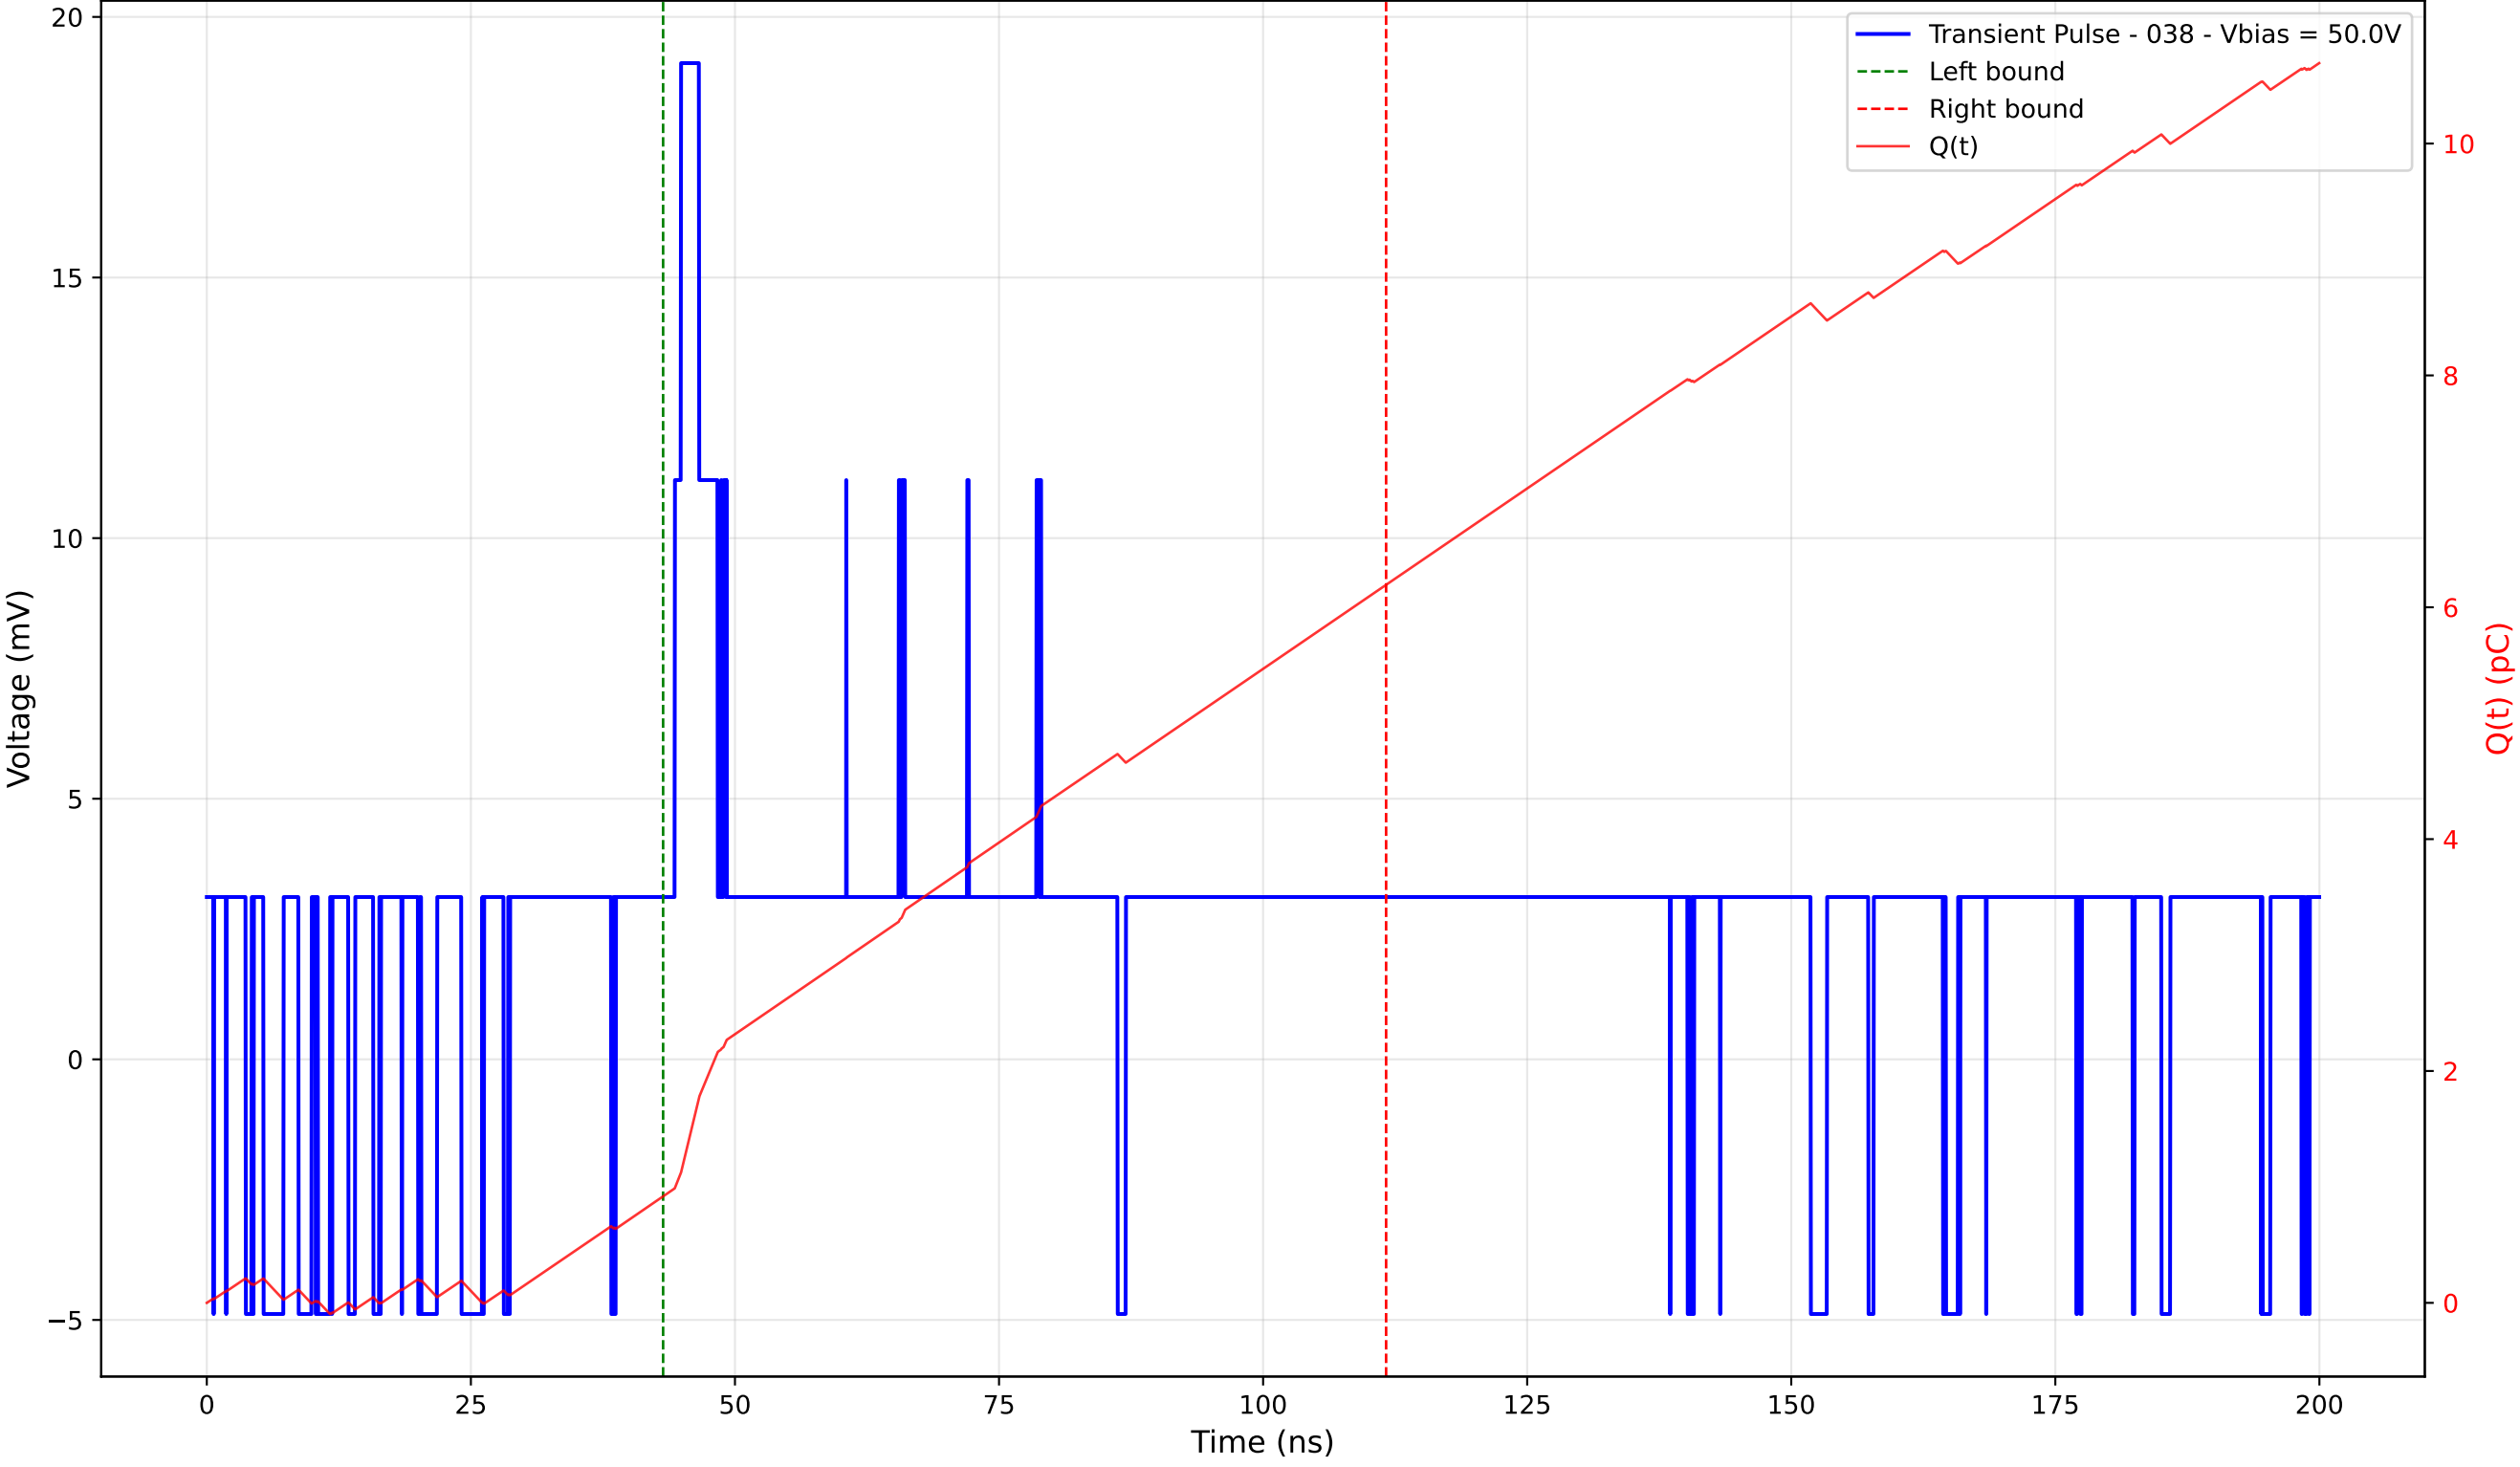

Transient Pulse - Sample: TD_4004 - Position: 435.0 μm - Charge: 1.02 pC - Rise Time: 0.42 ns

