


TCT Run 039 Summary

Parameter	Value
Run	Run039
Surface	N/A
Edge	x
Sample	TD_4004
Vbias (V)	25.0
DAC (%)	56.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\Run039
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A

Collected Charge

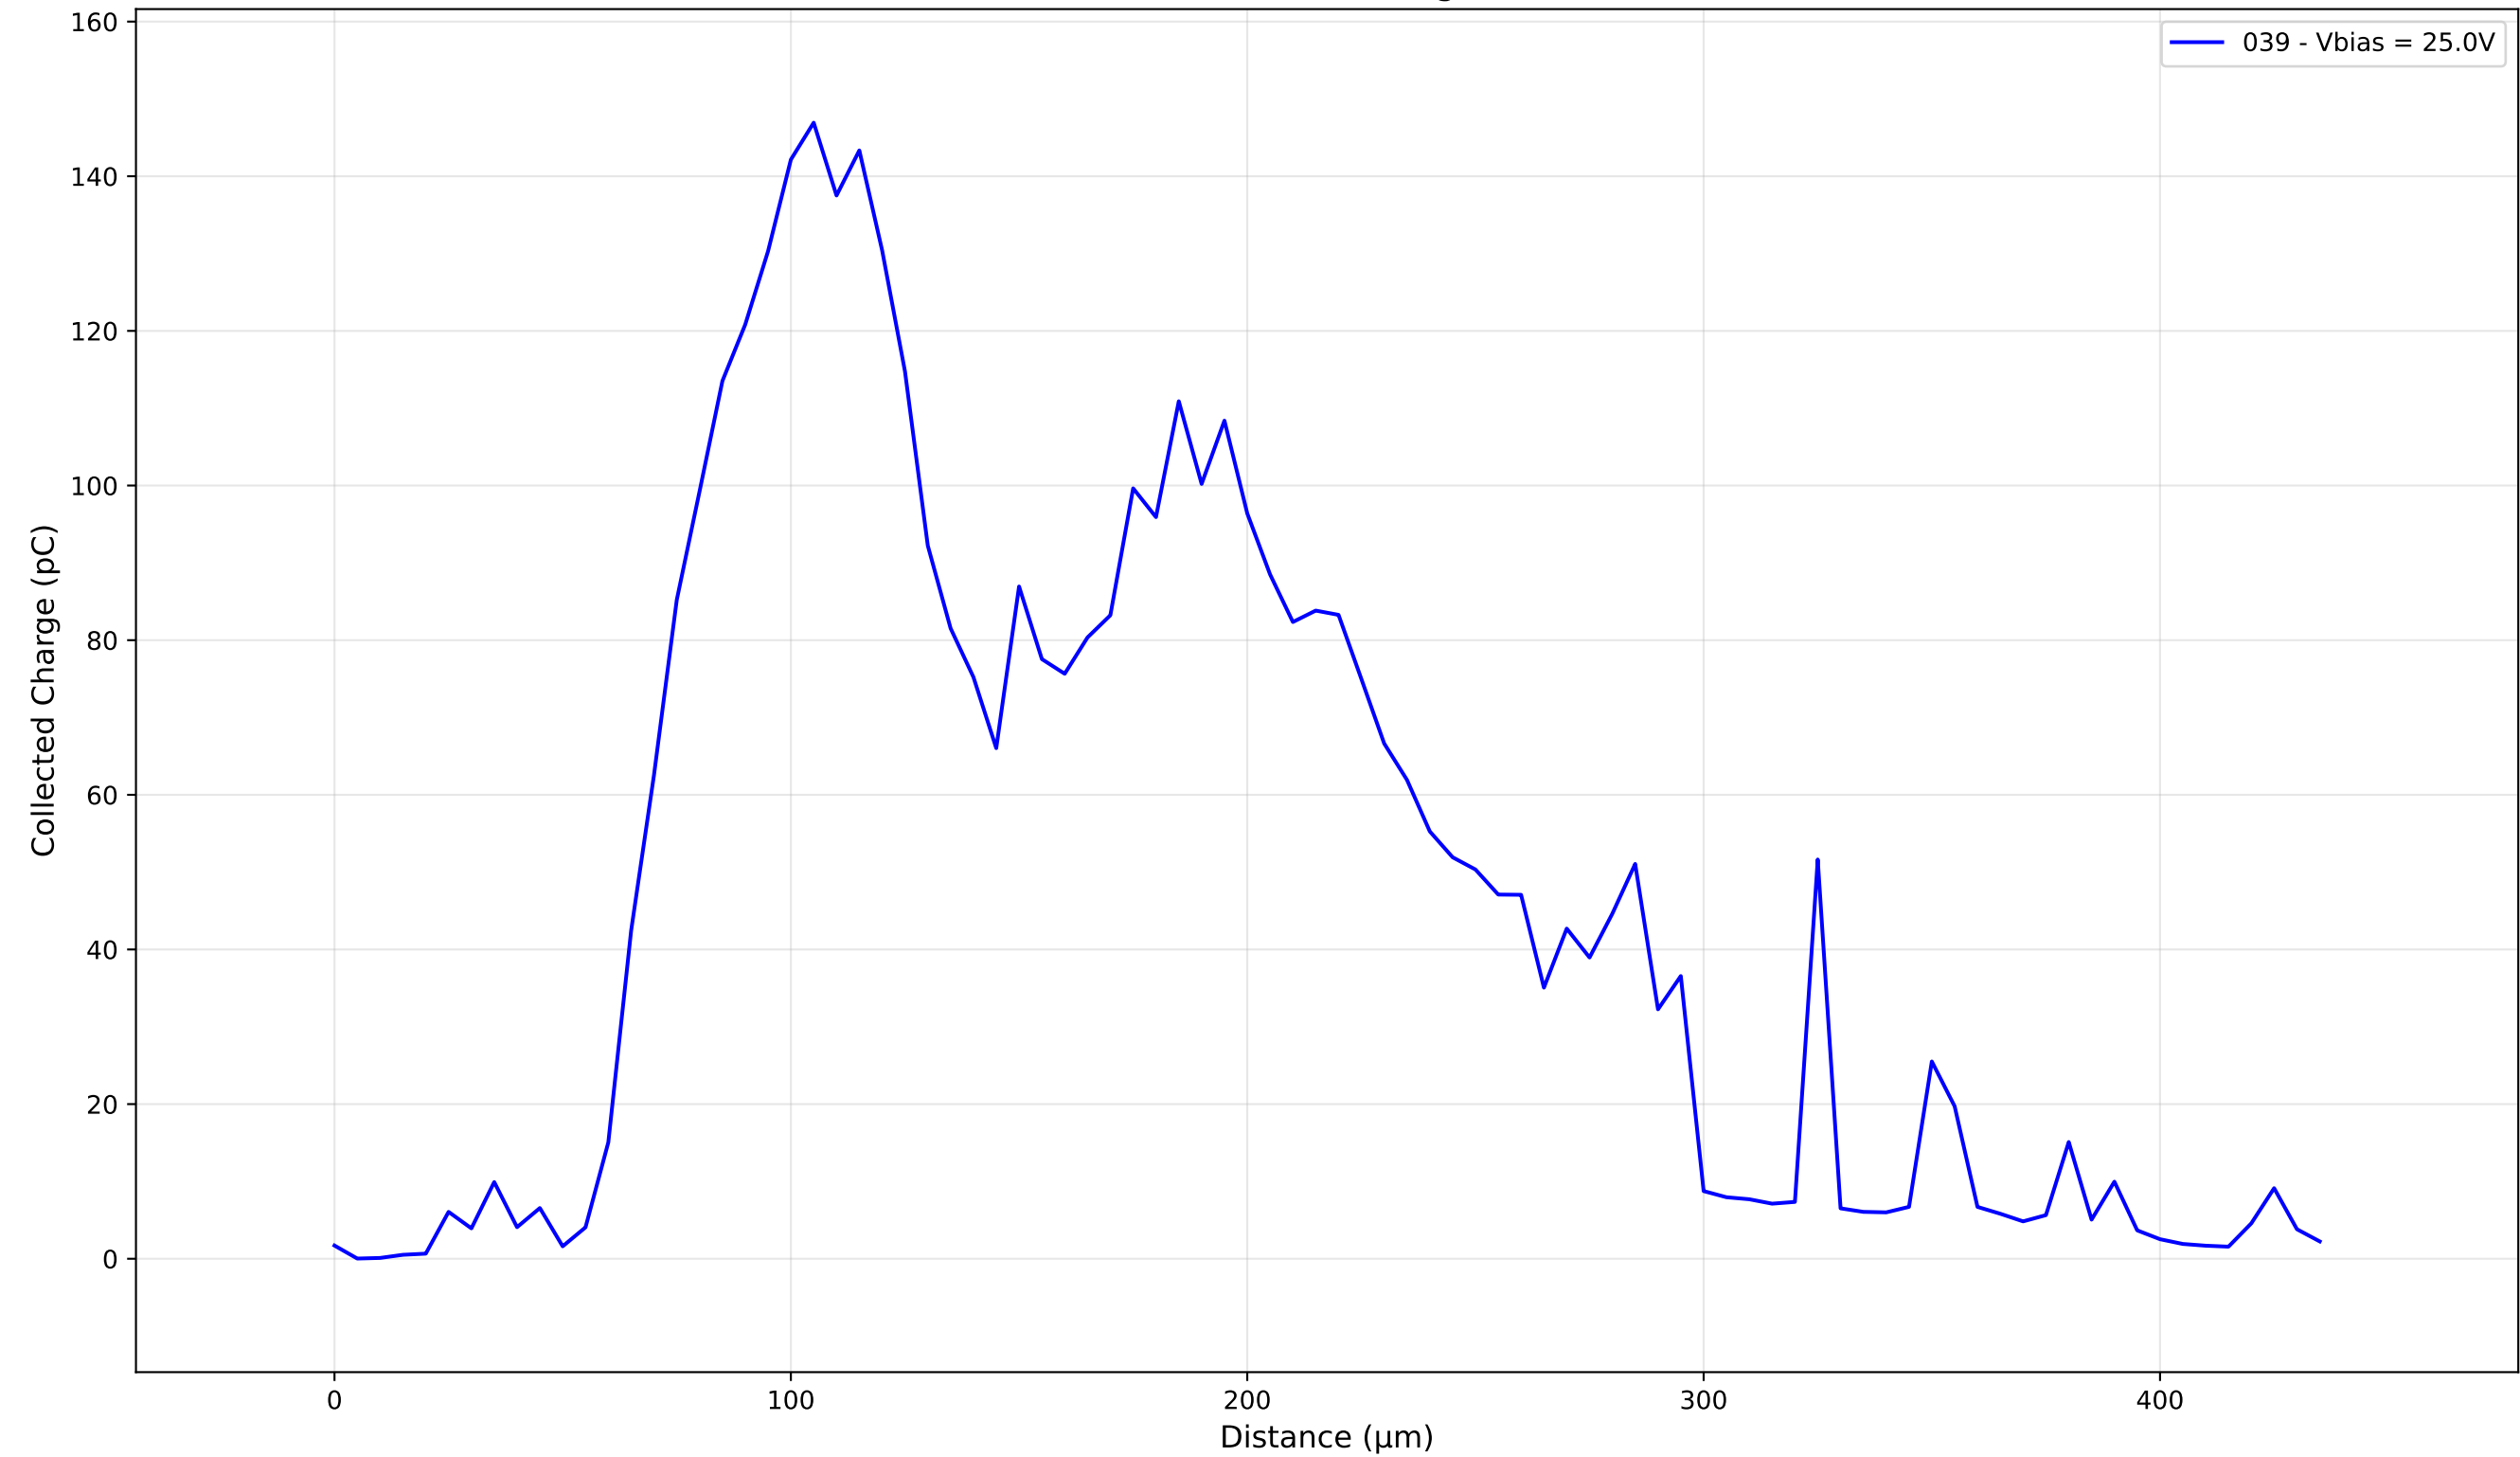

Collected Charge

039 - Vbias = 25.0V

Collected Charge [a.u.]

1.0
0.8
0.6
0.4
0.2
0.0

0


100

200


300

400


Distance (μm)

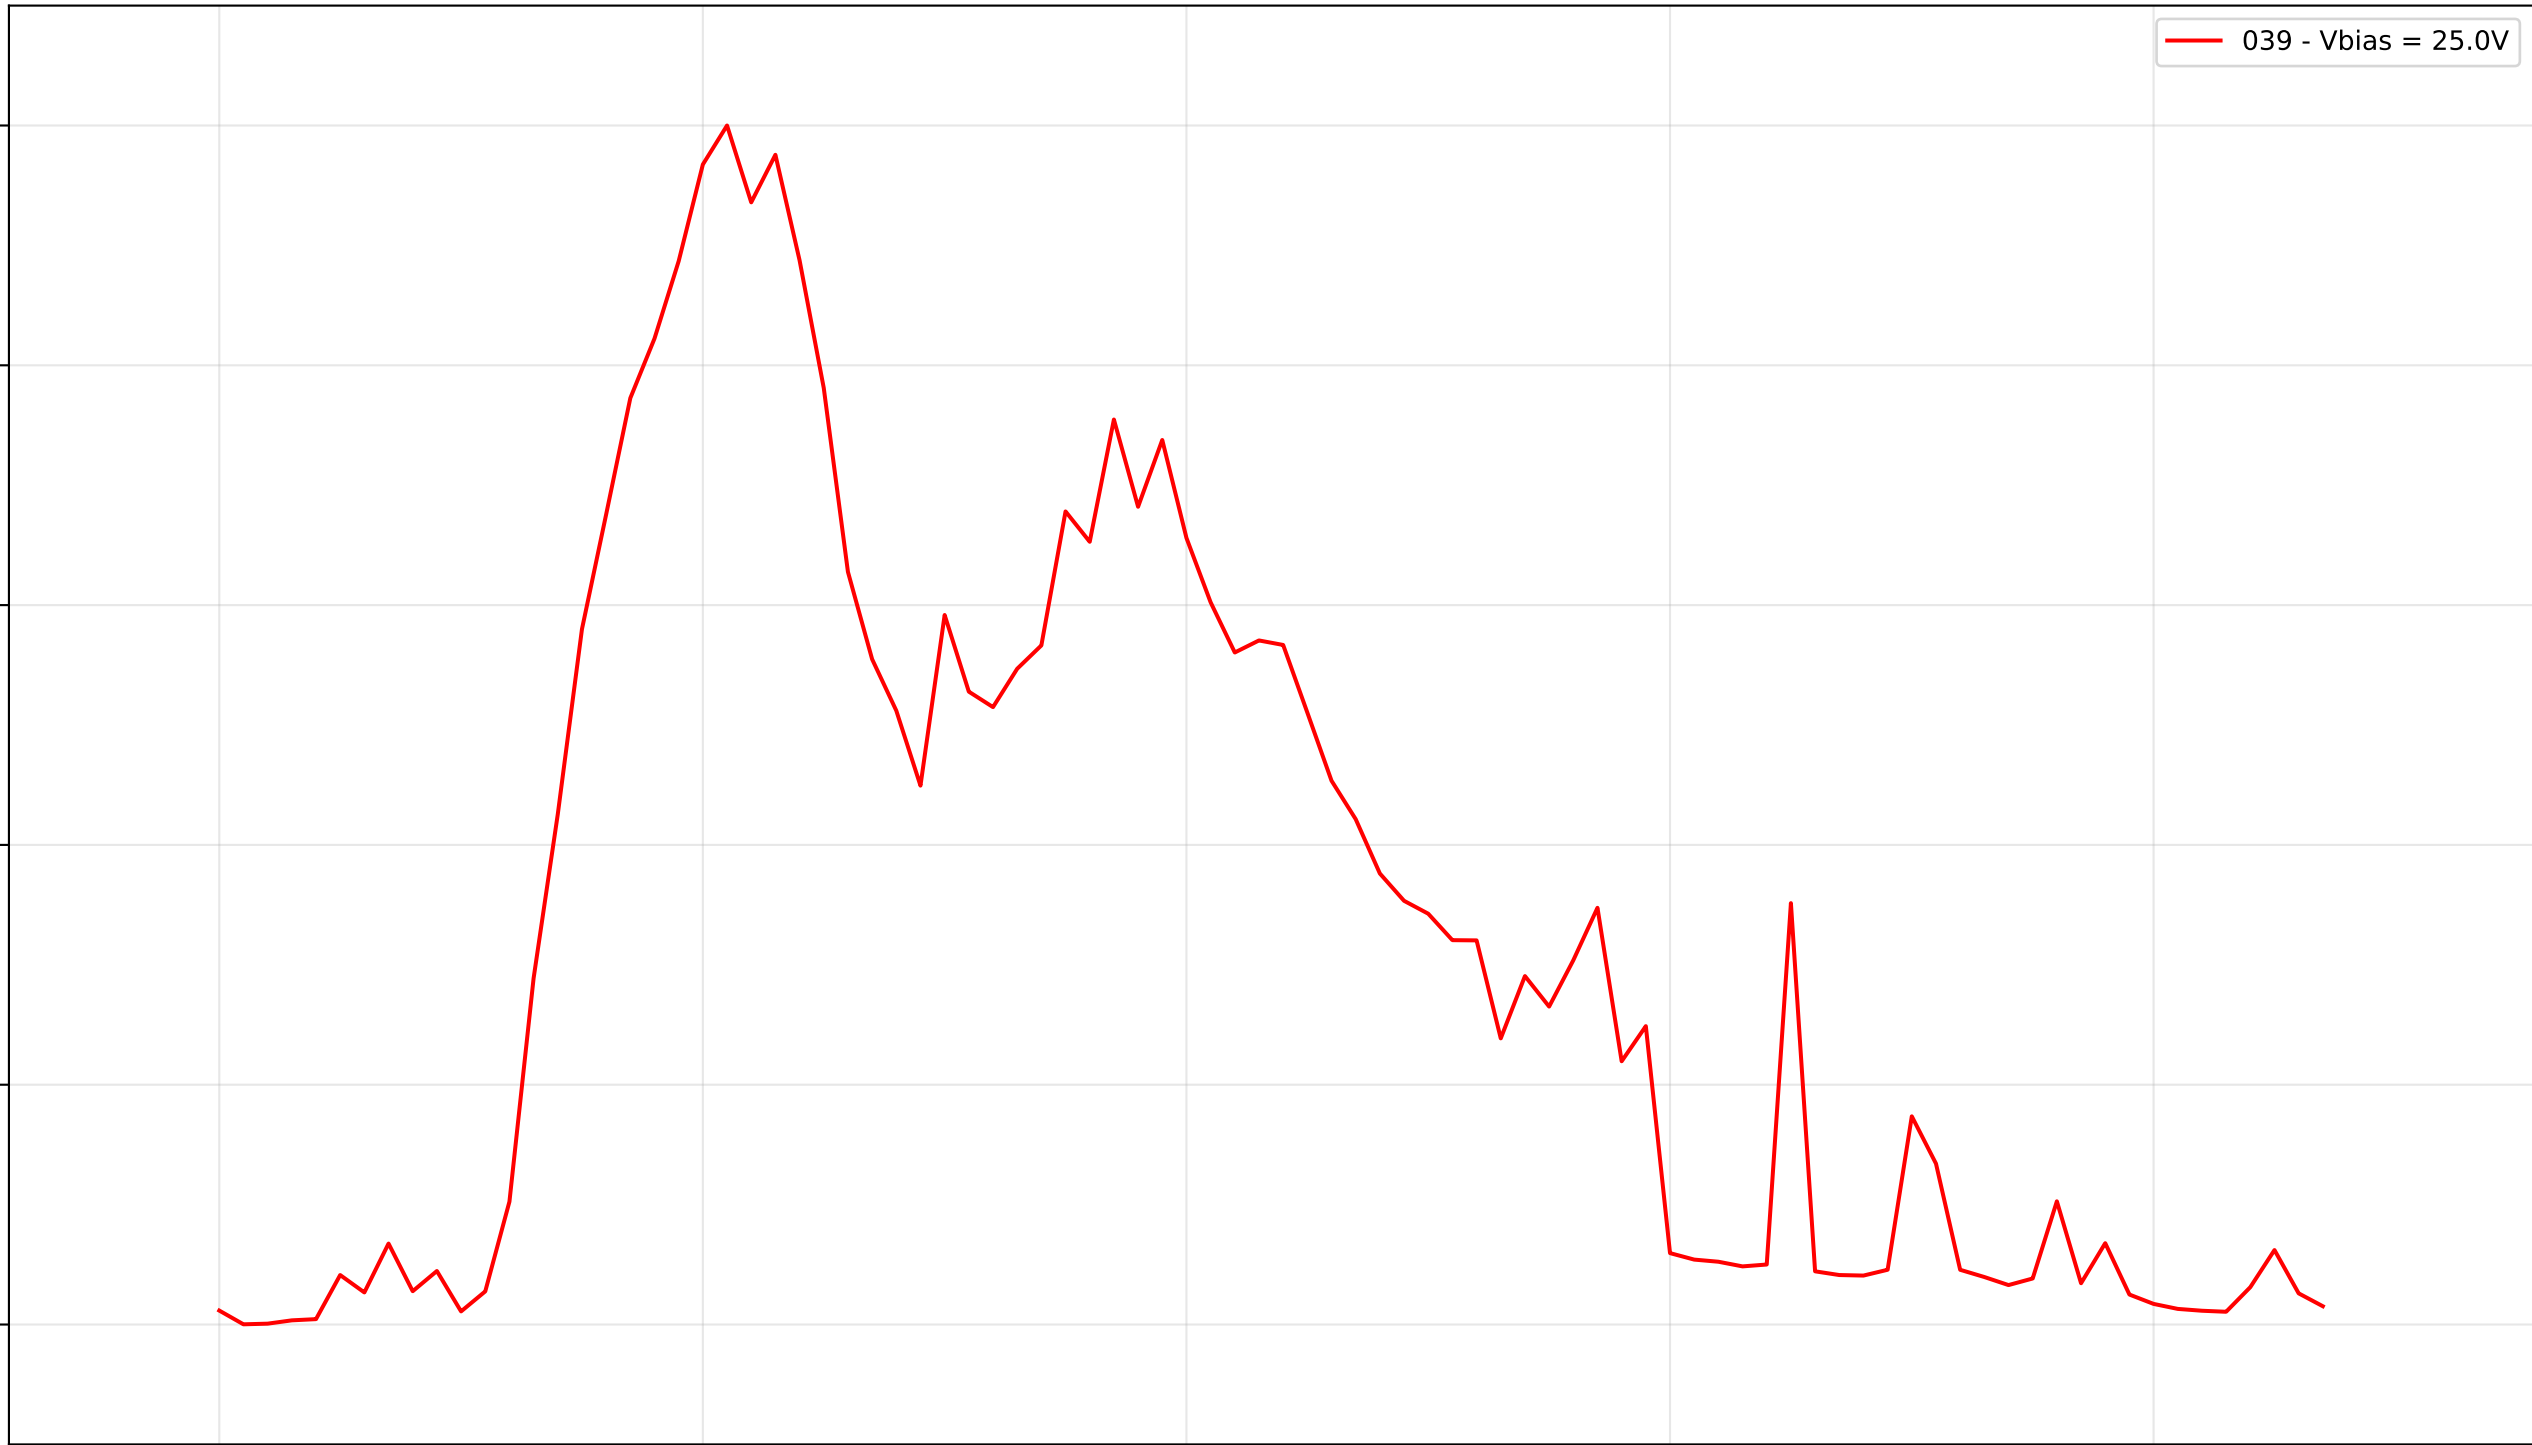


Rise Time

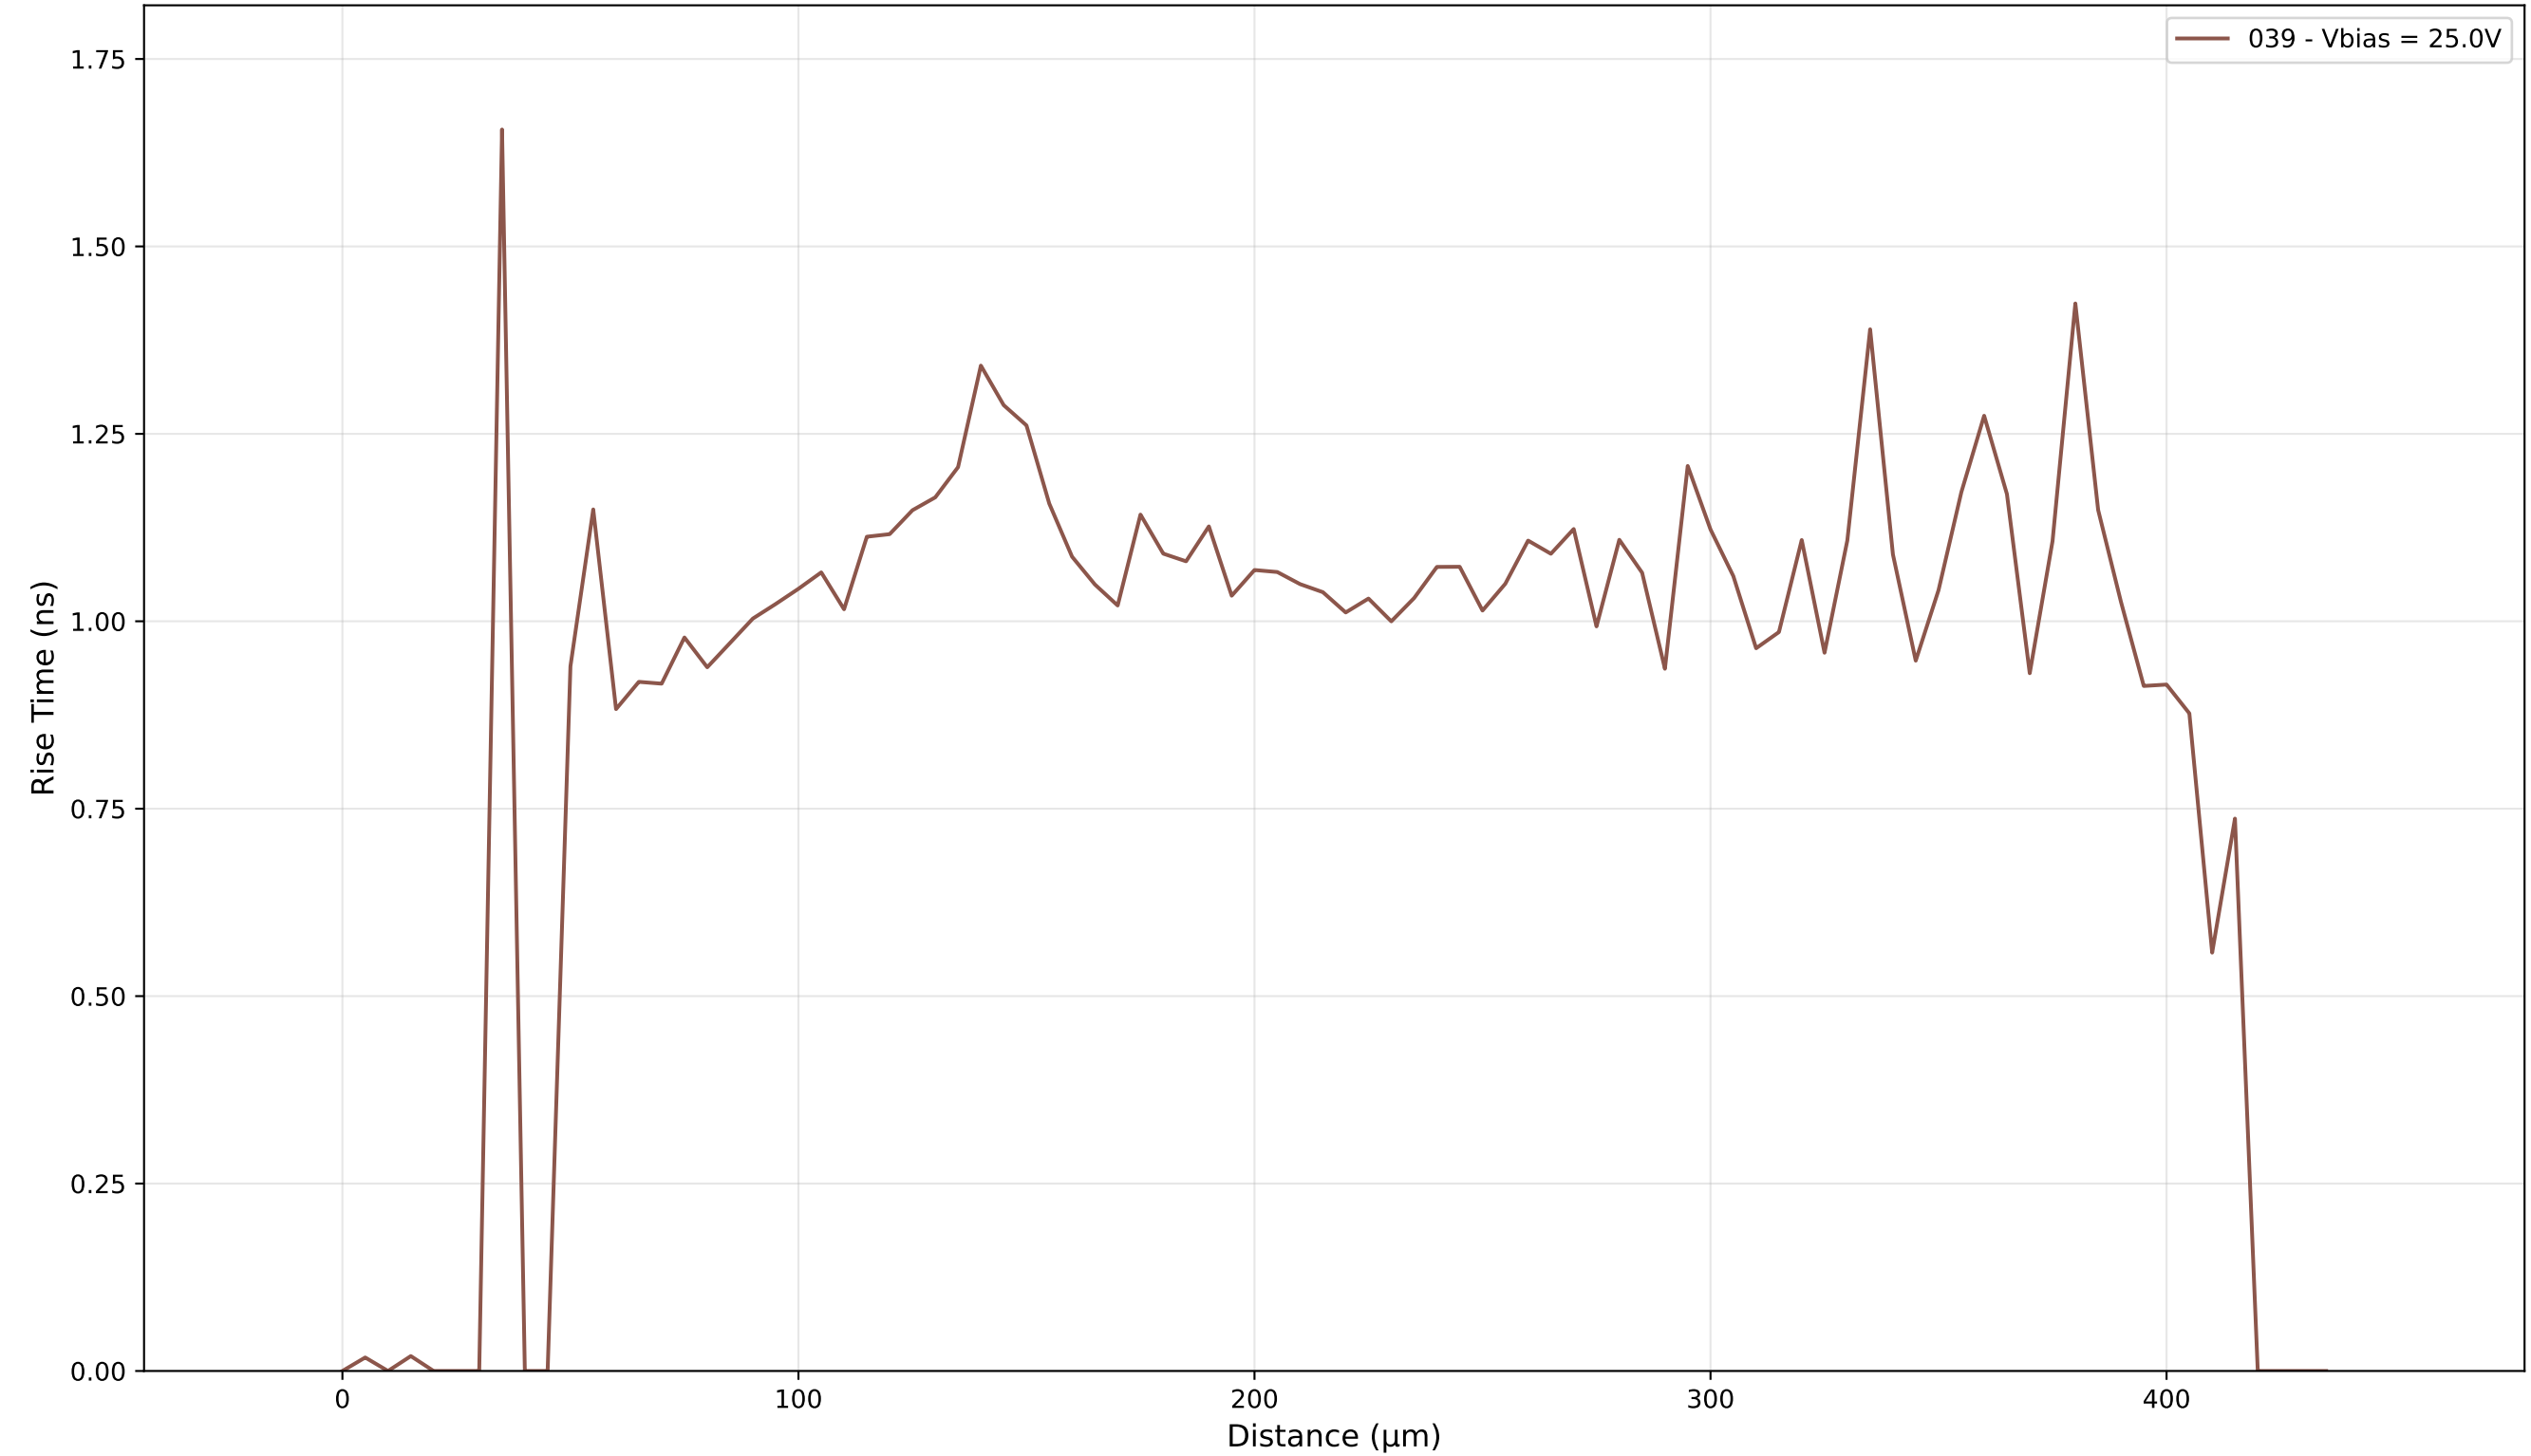


Amplitude

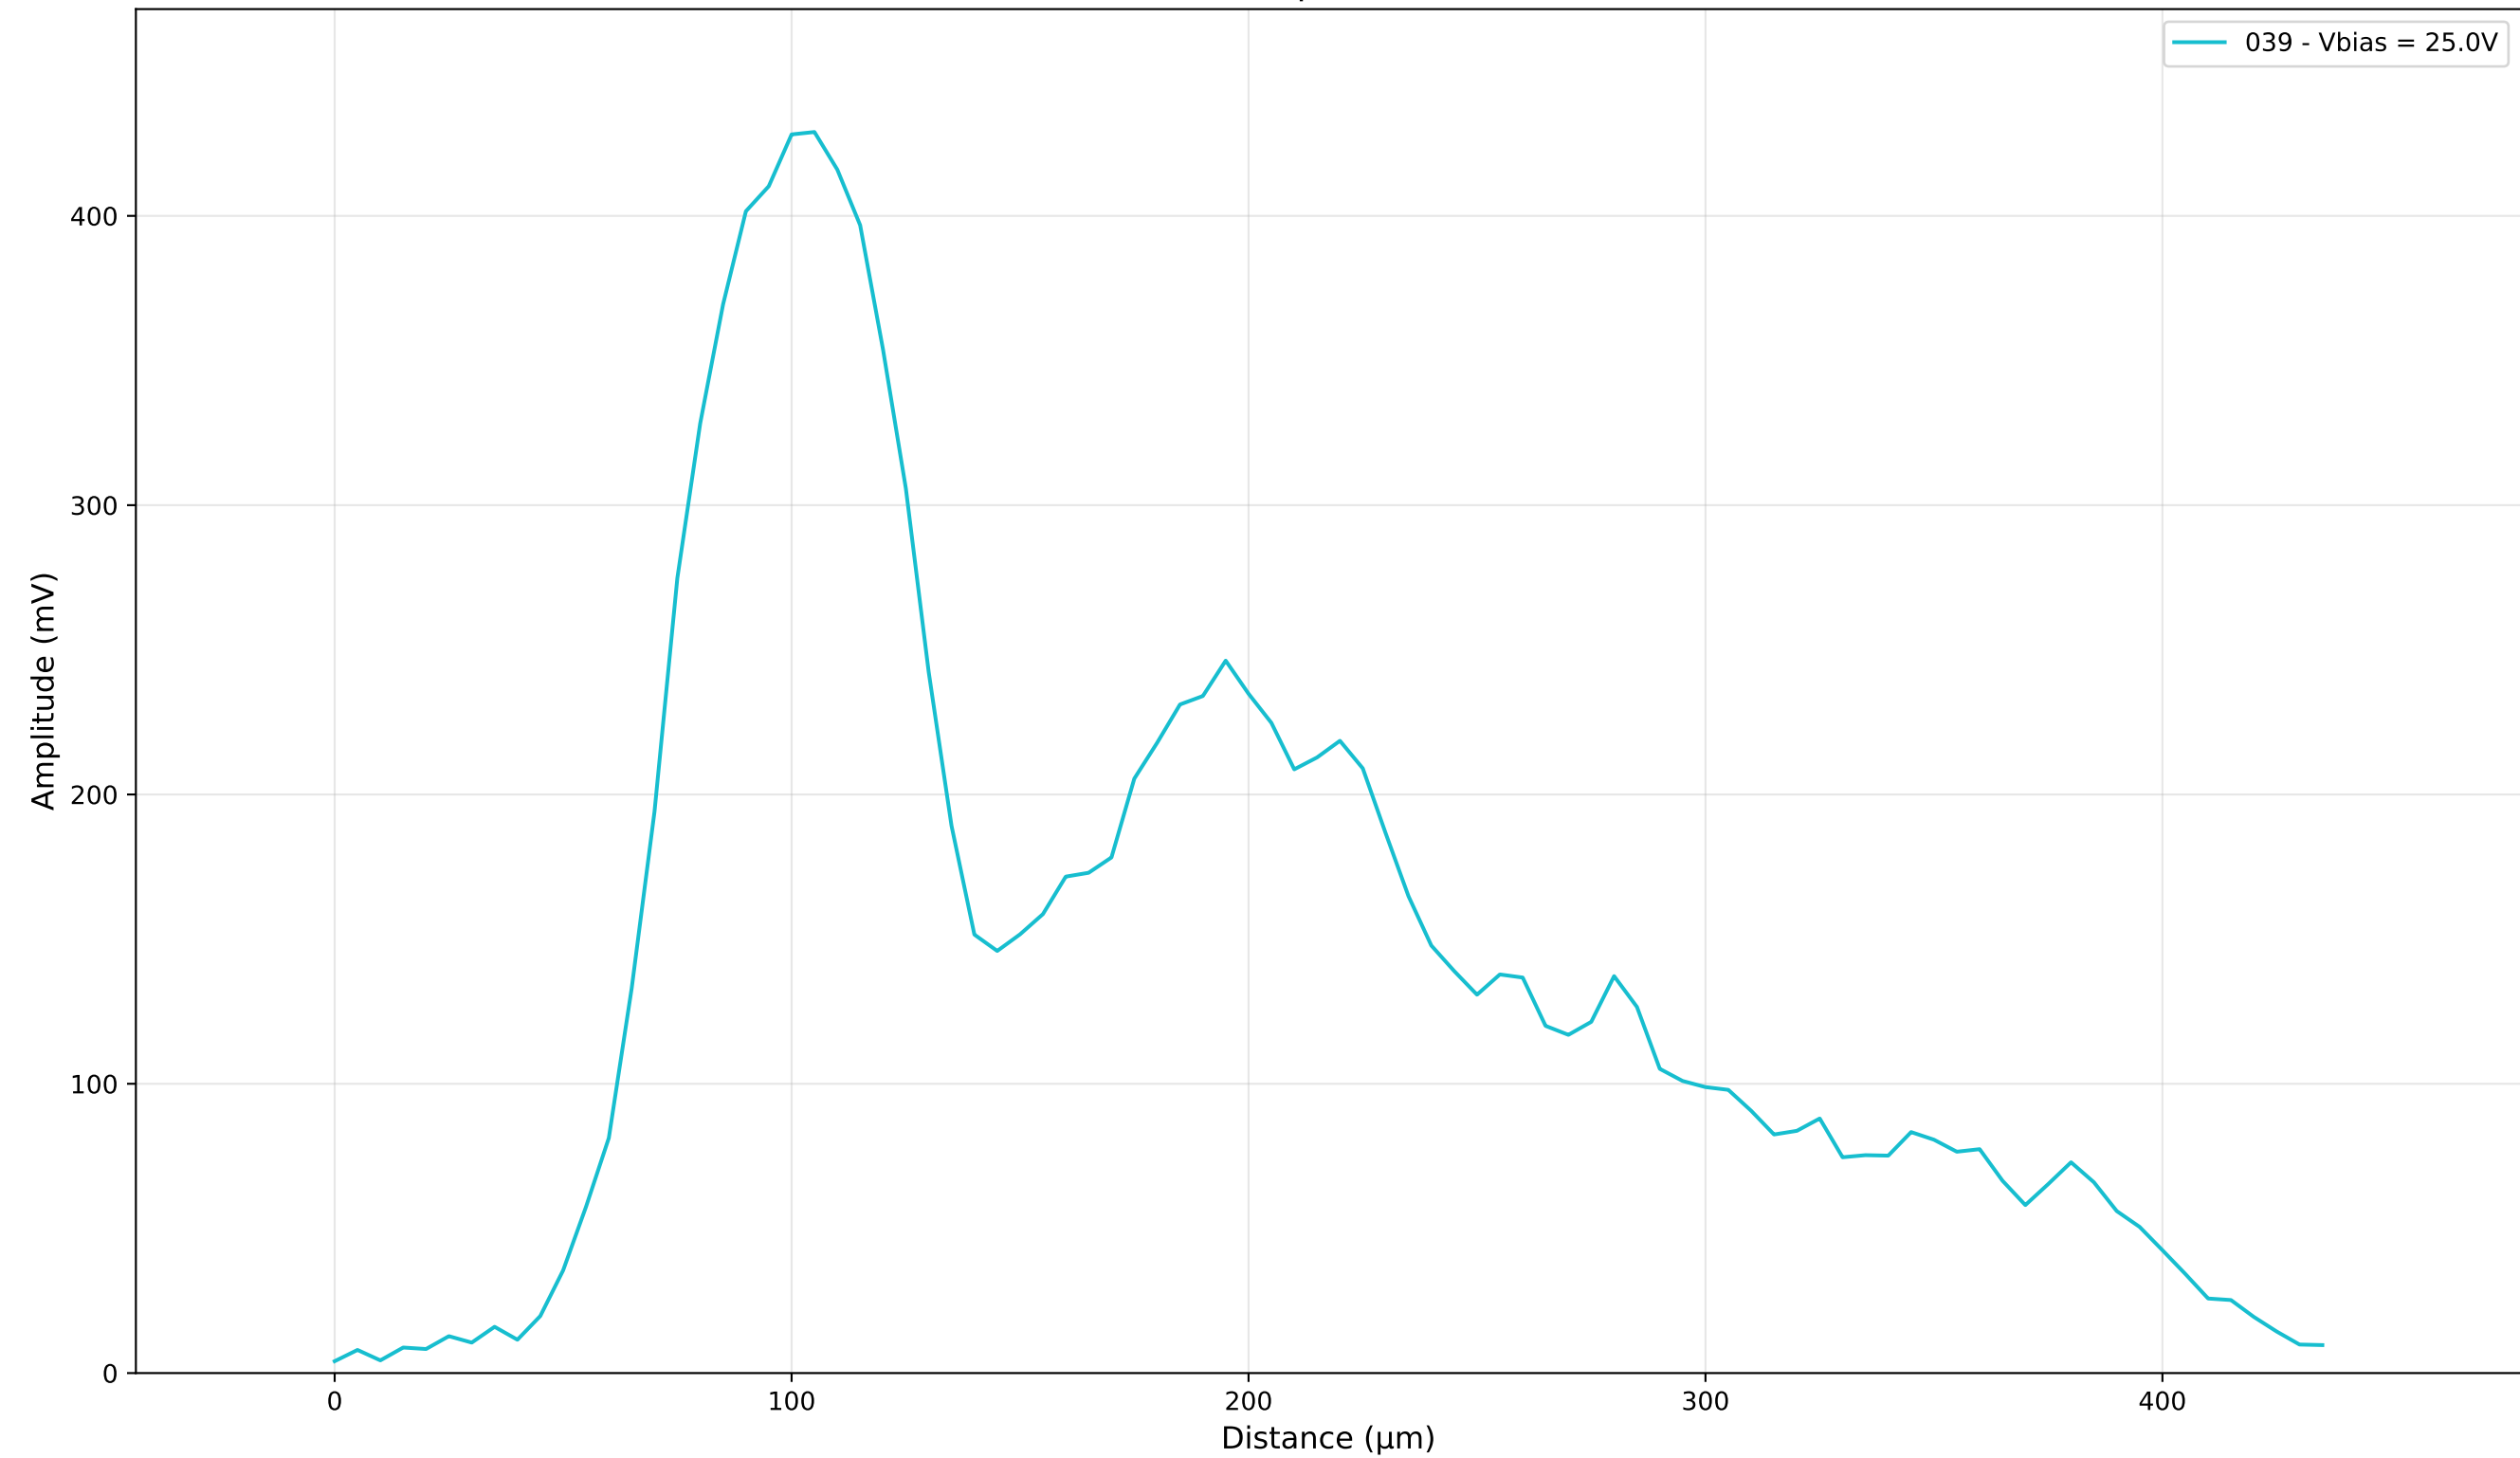


FWHM

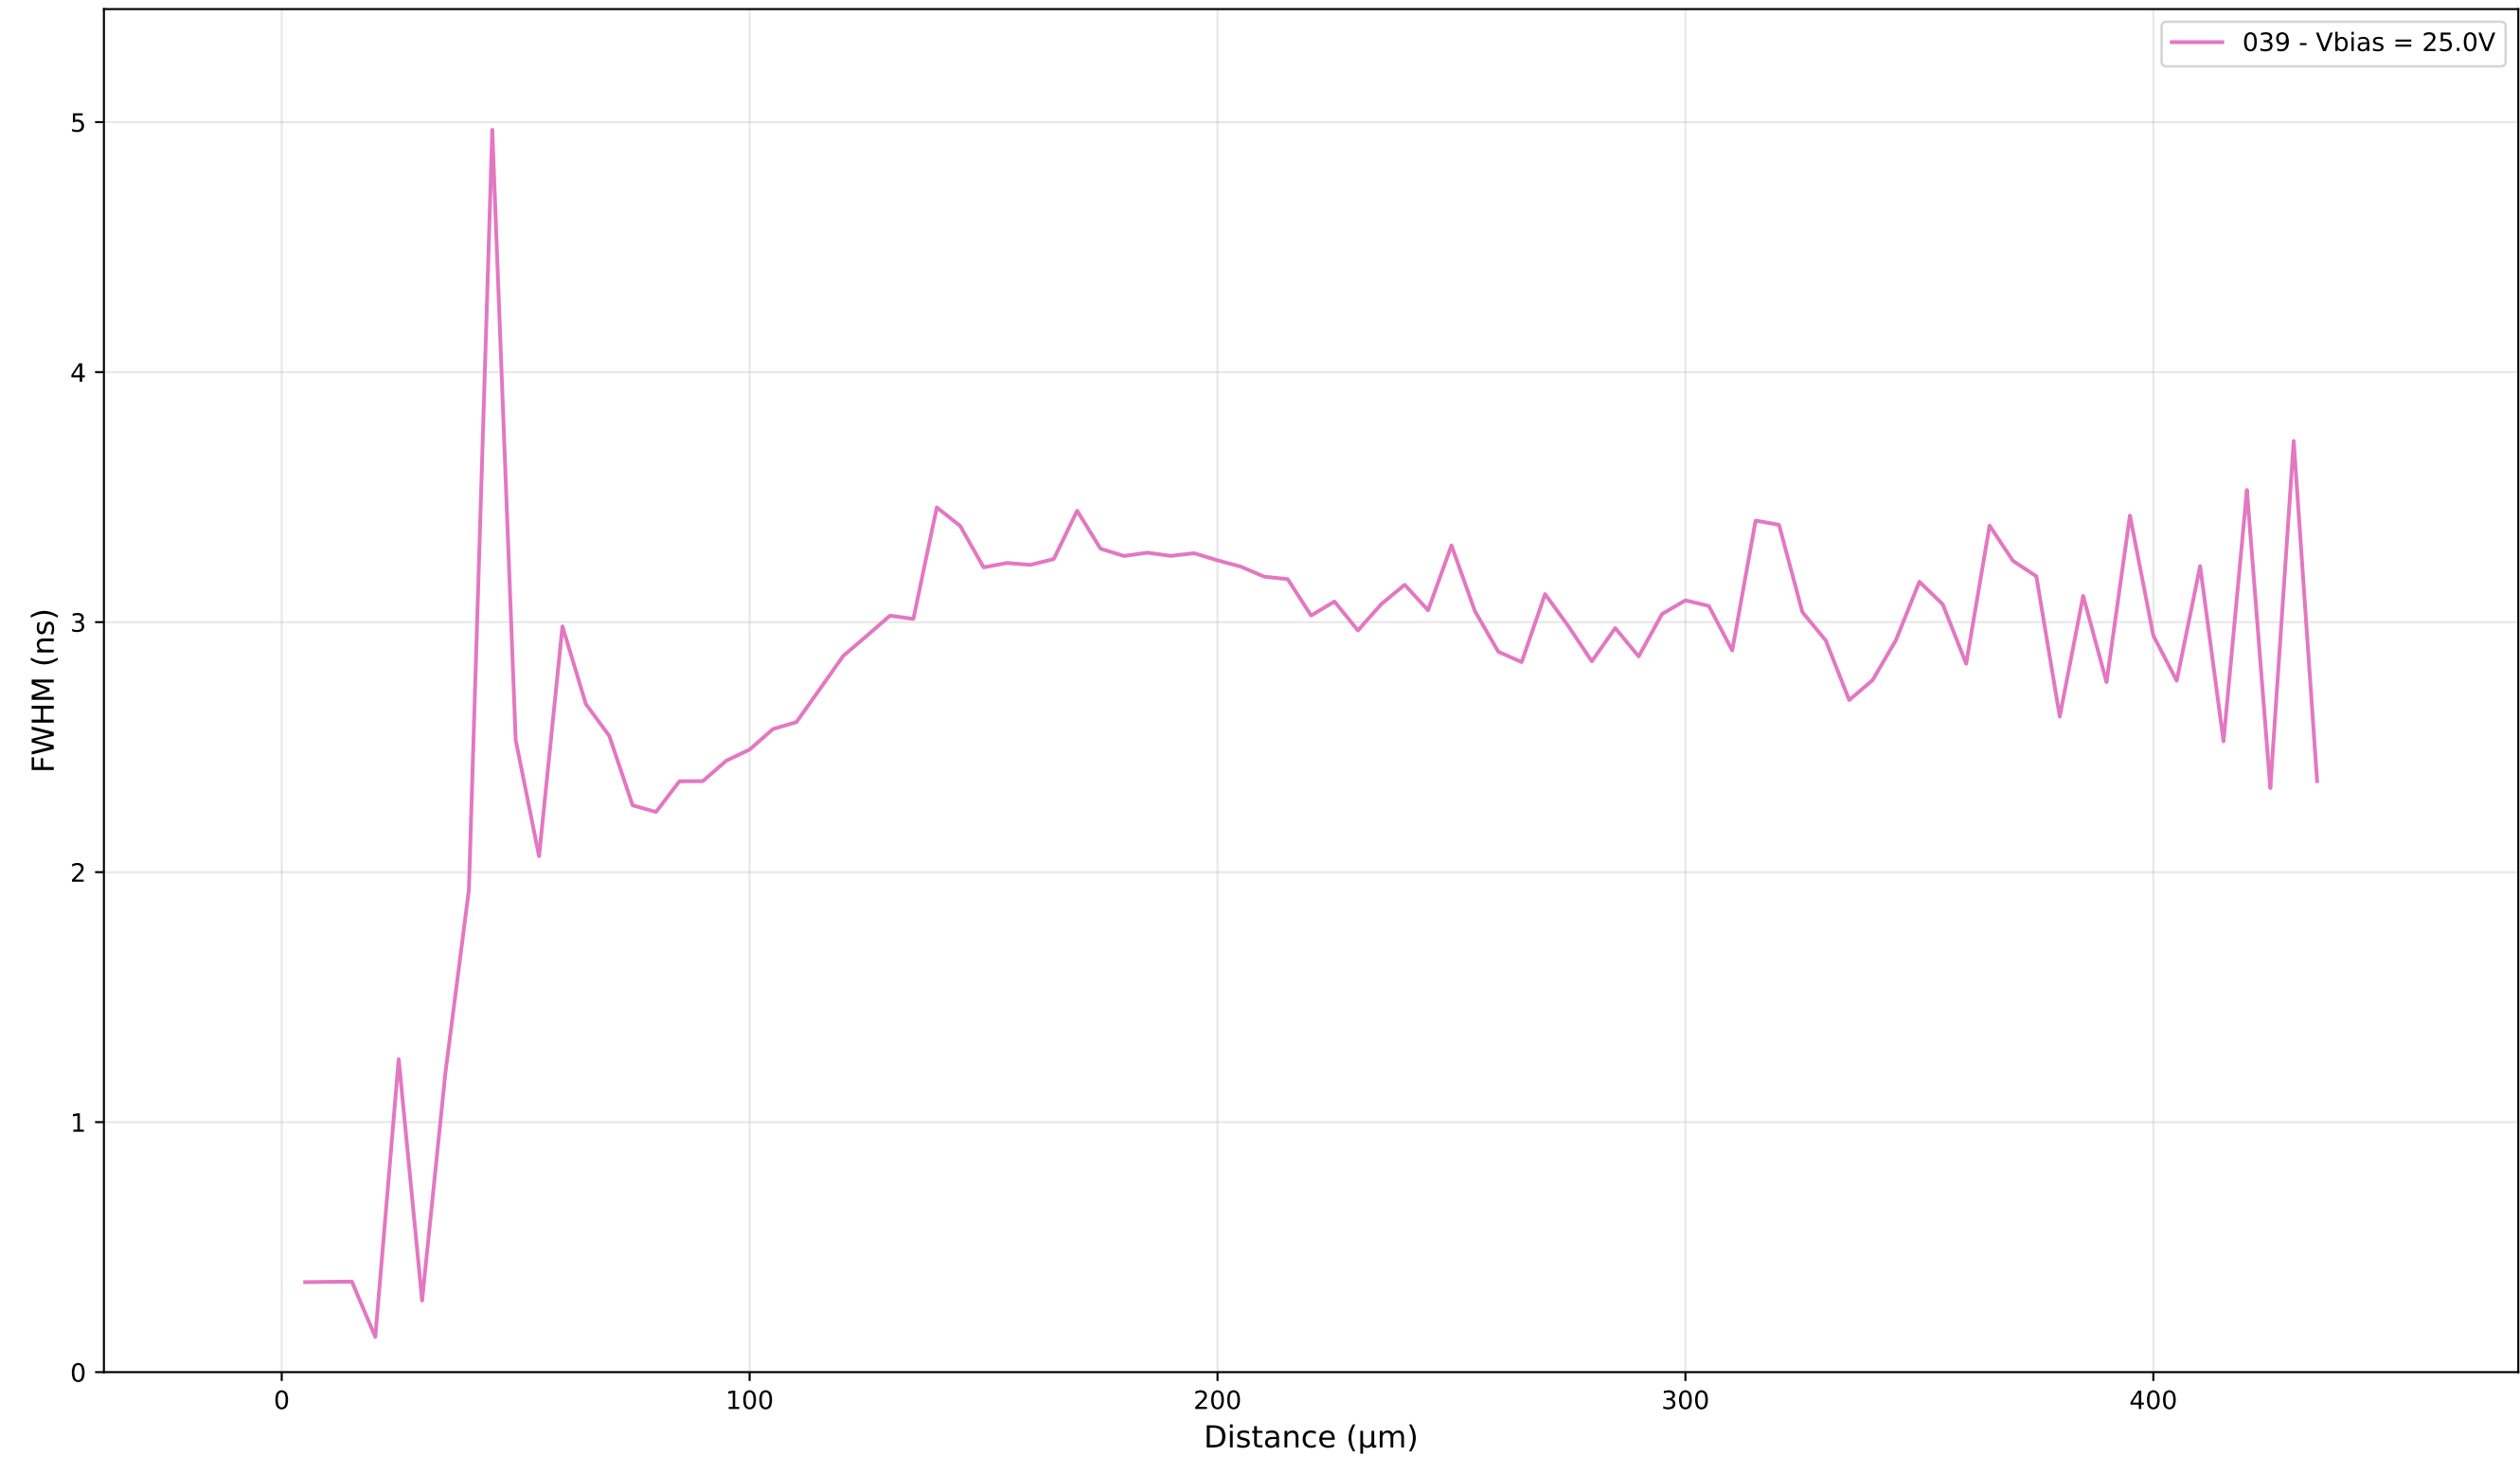


Transient Pulse - Sample: TD_4004 - Position: 0.0 μ m - Charge: 1.71 pC - Rise Time: 0.00 ns (N/A)

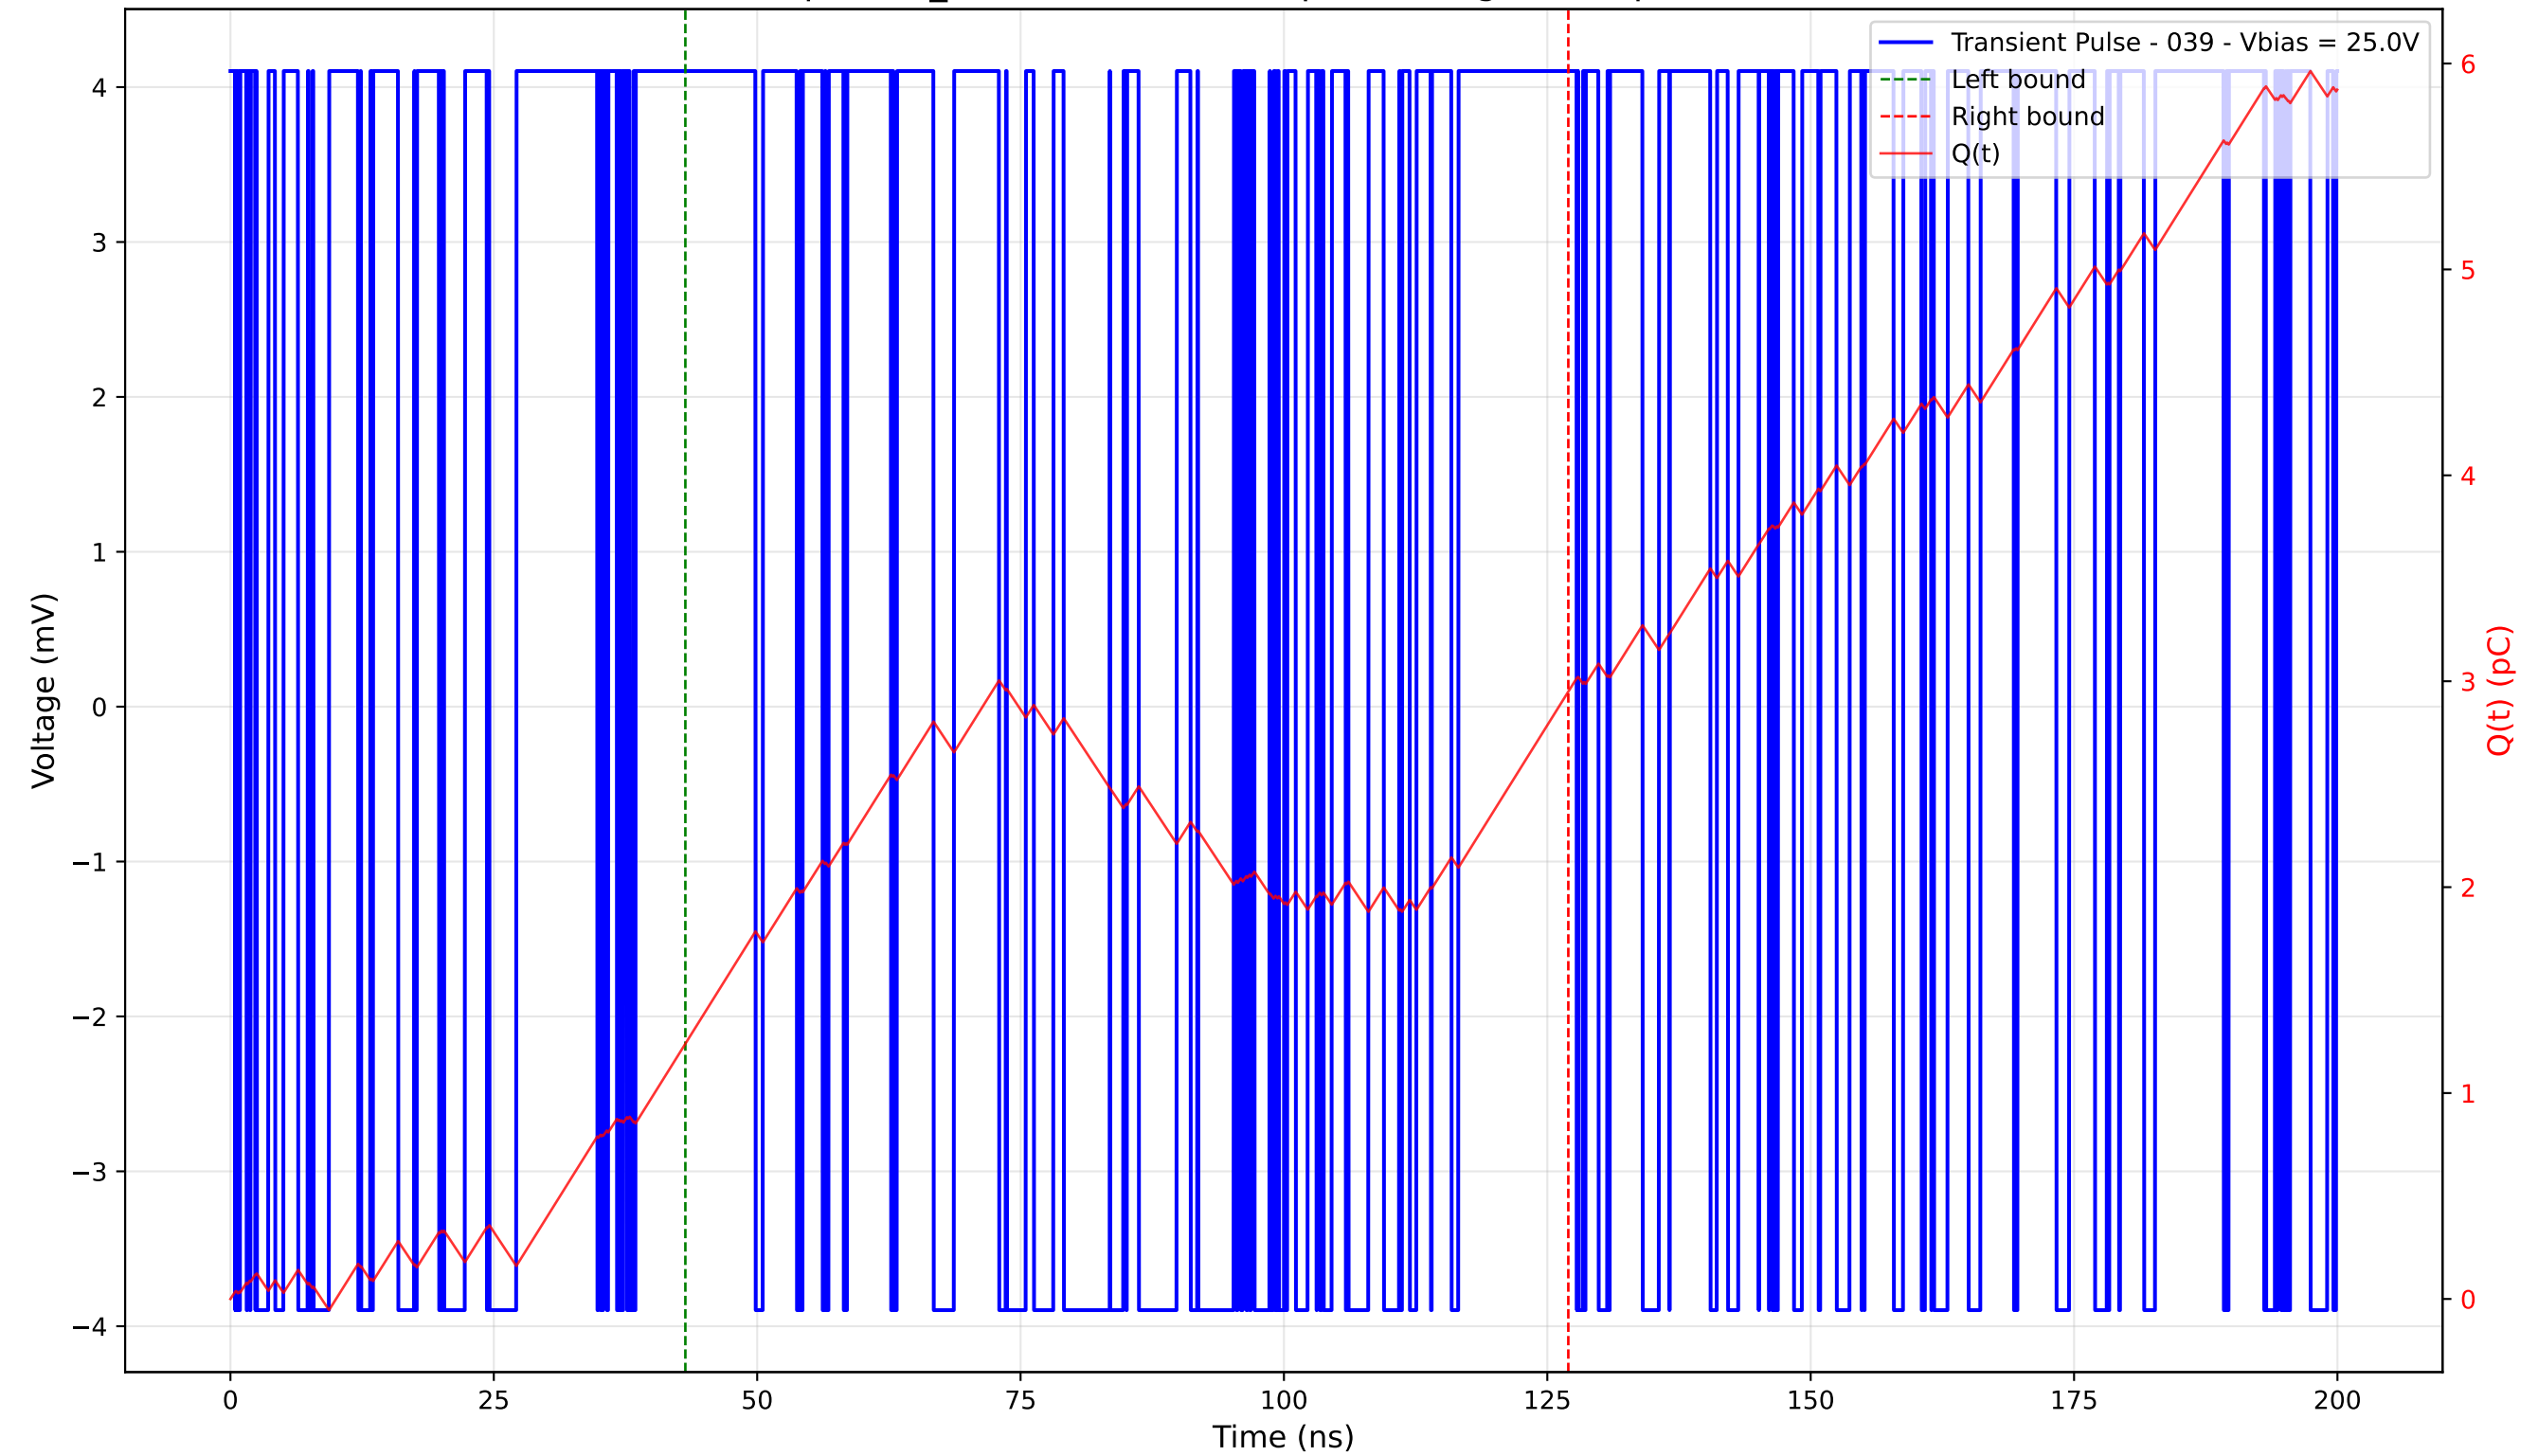


Transient Pulse - Sample: TD_4004 - Position: 5.0 μm - Charge: 0.03 pC - Rise Time: 0.02 ns

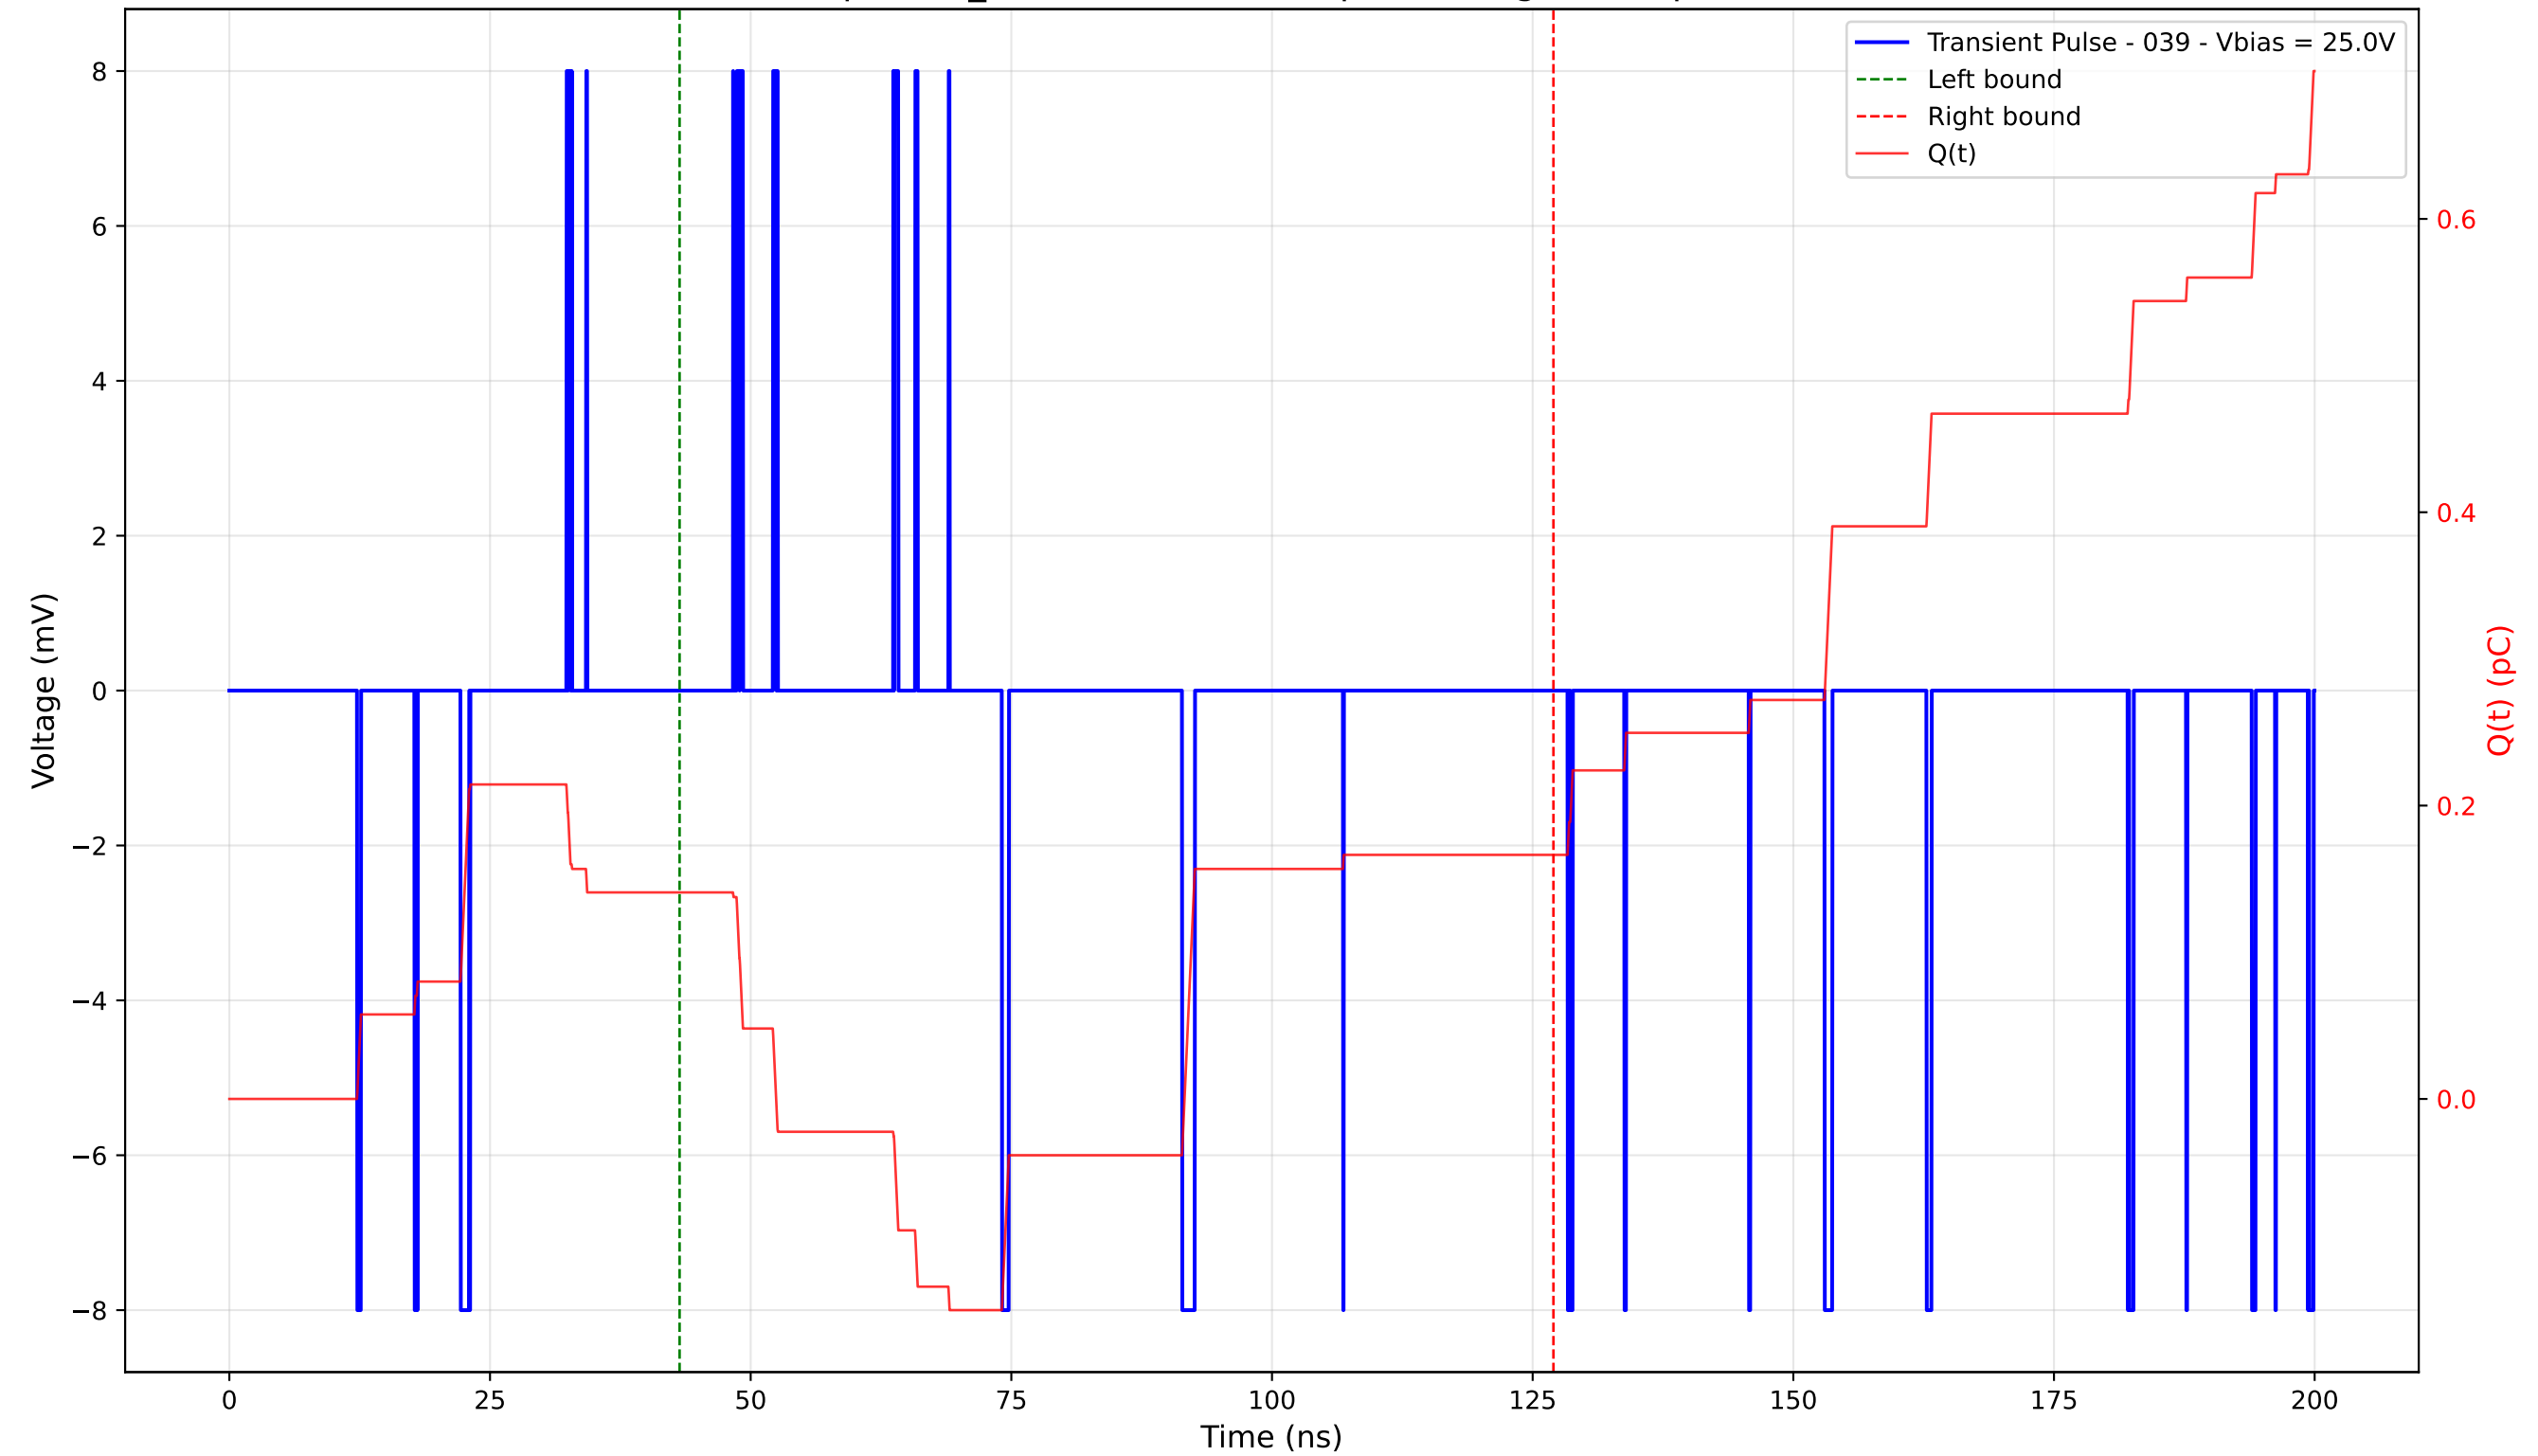


Transient Pulse - Sample: TD_4004 - Position: 10.0 μ m - Charge: 0.11 pC - Rise Time: 0.00 ns (N/A)

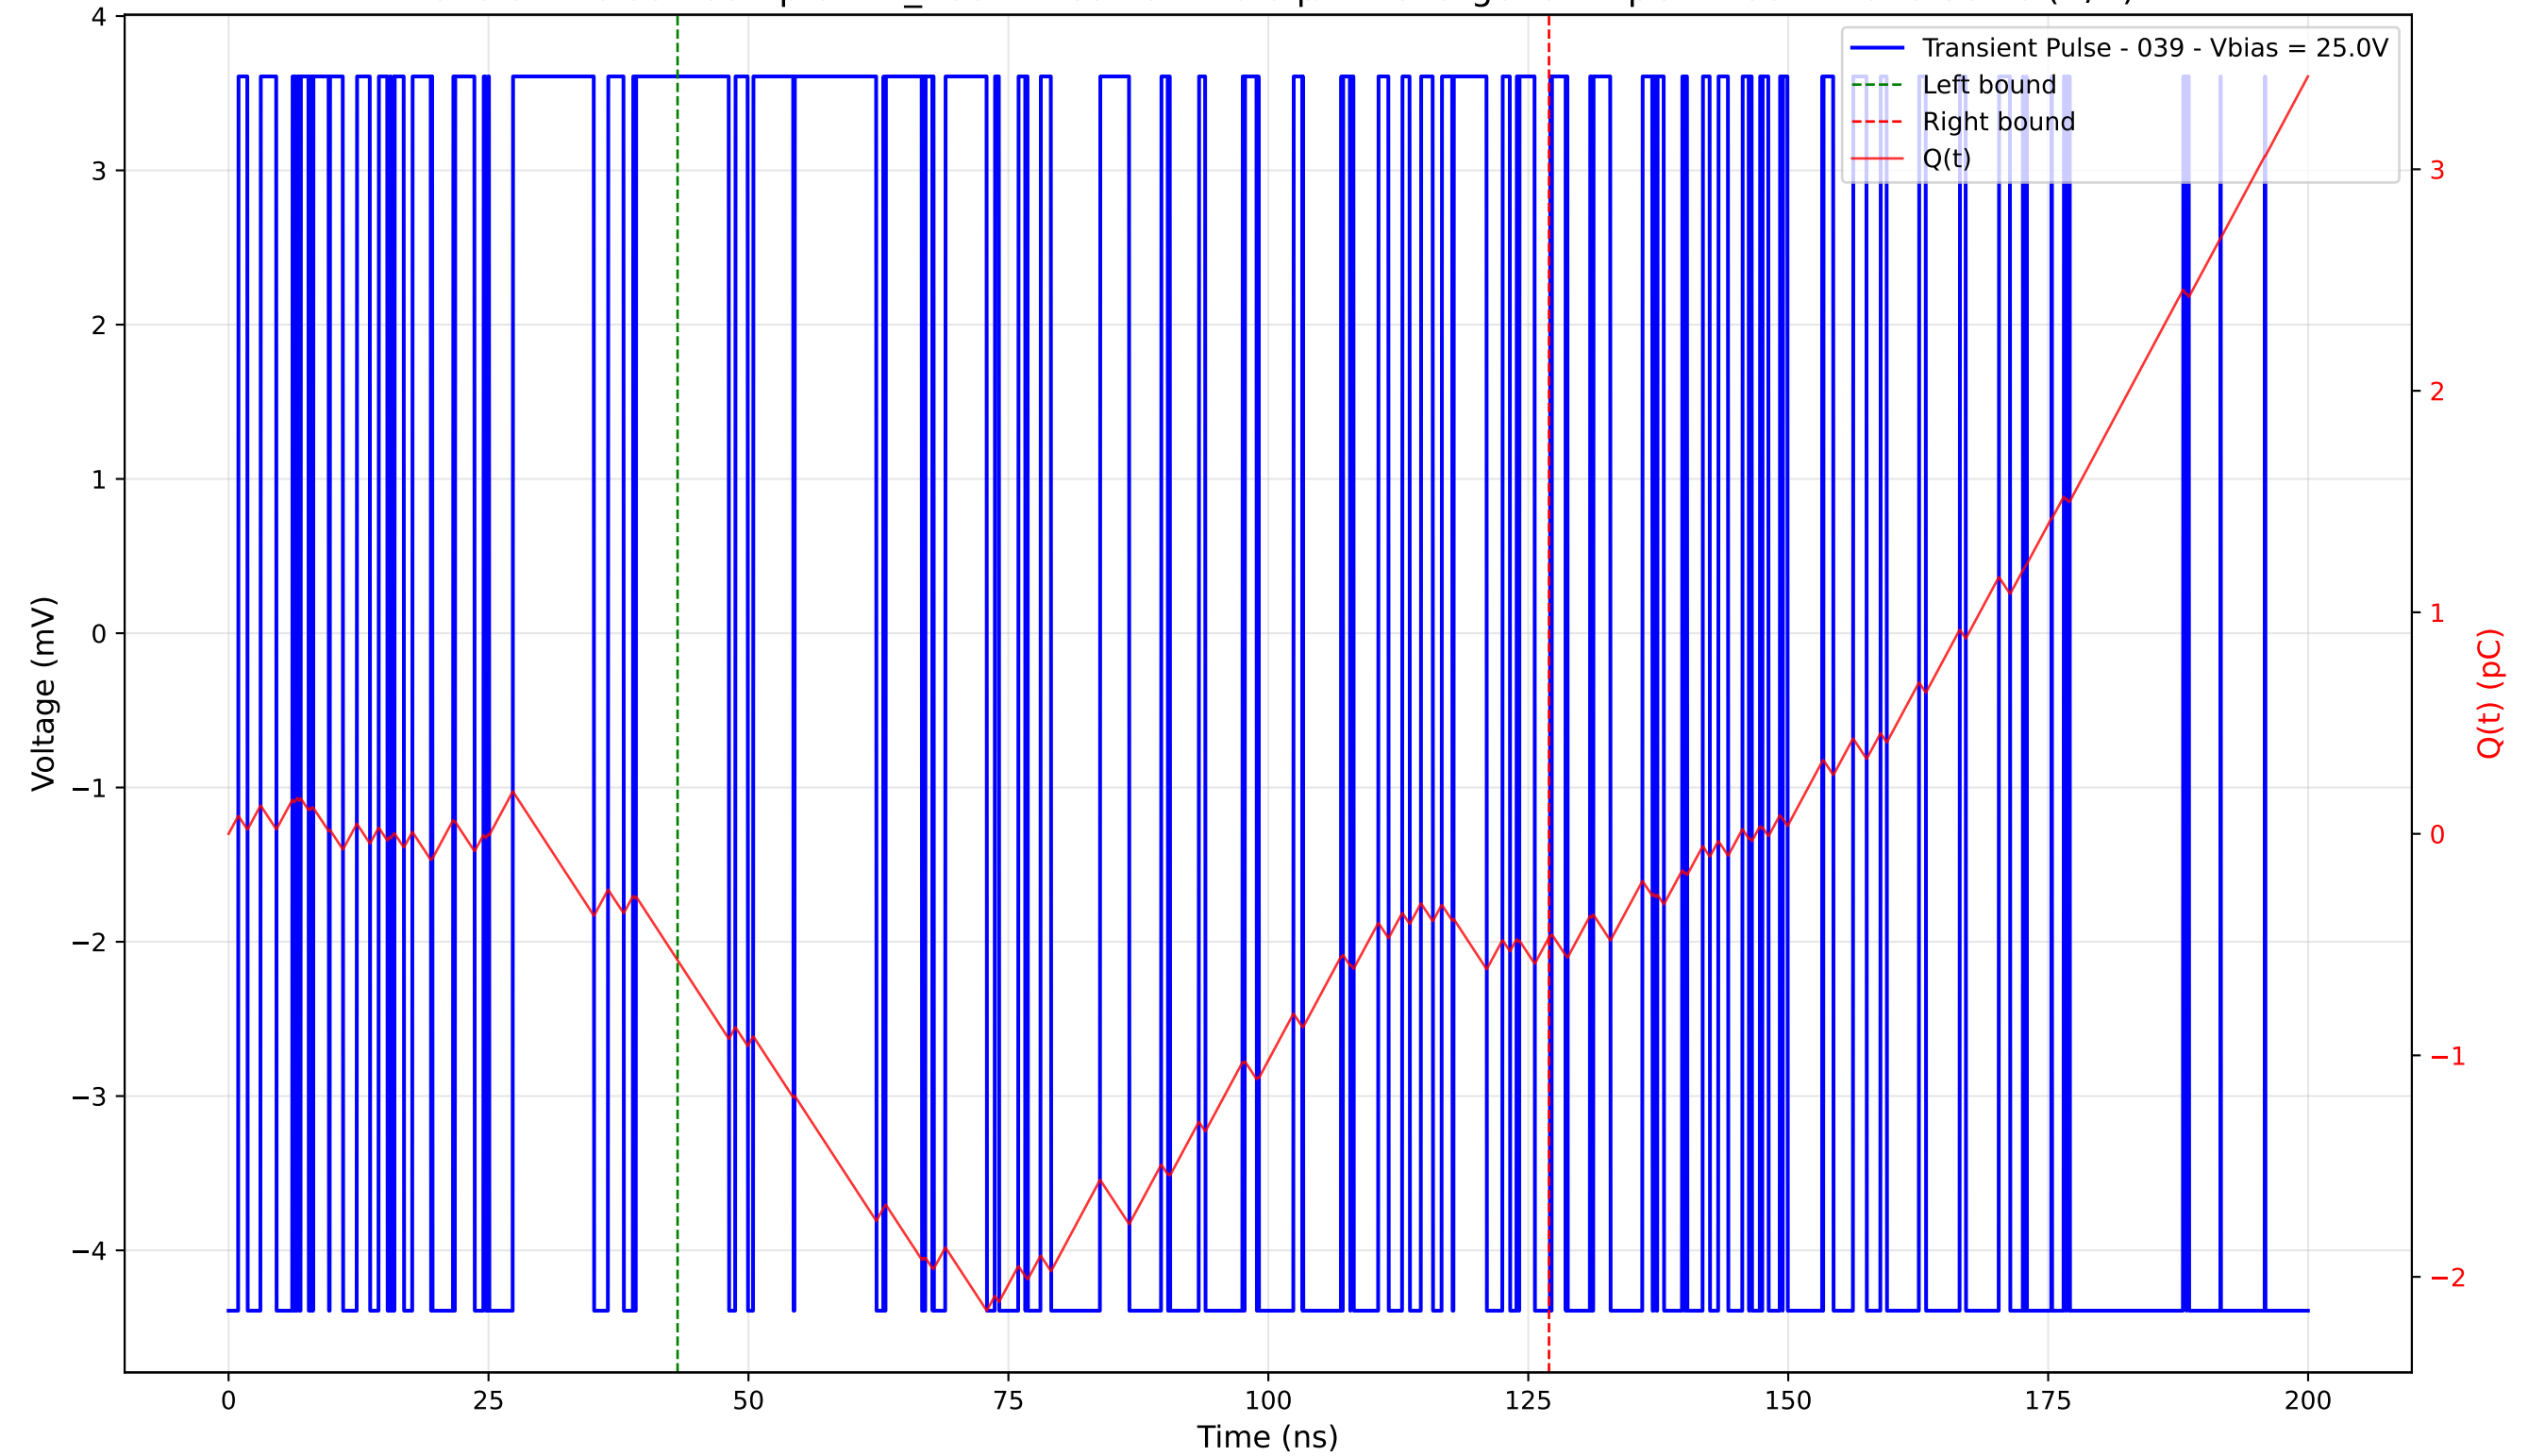


Transient Pulse - Sample: TD_4004 - Position: 15.0 μm - Charge: 0.51 pC - Rise Time: 0.02 ns

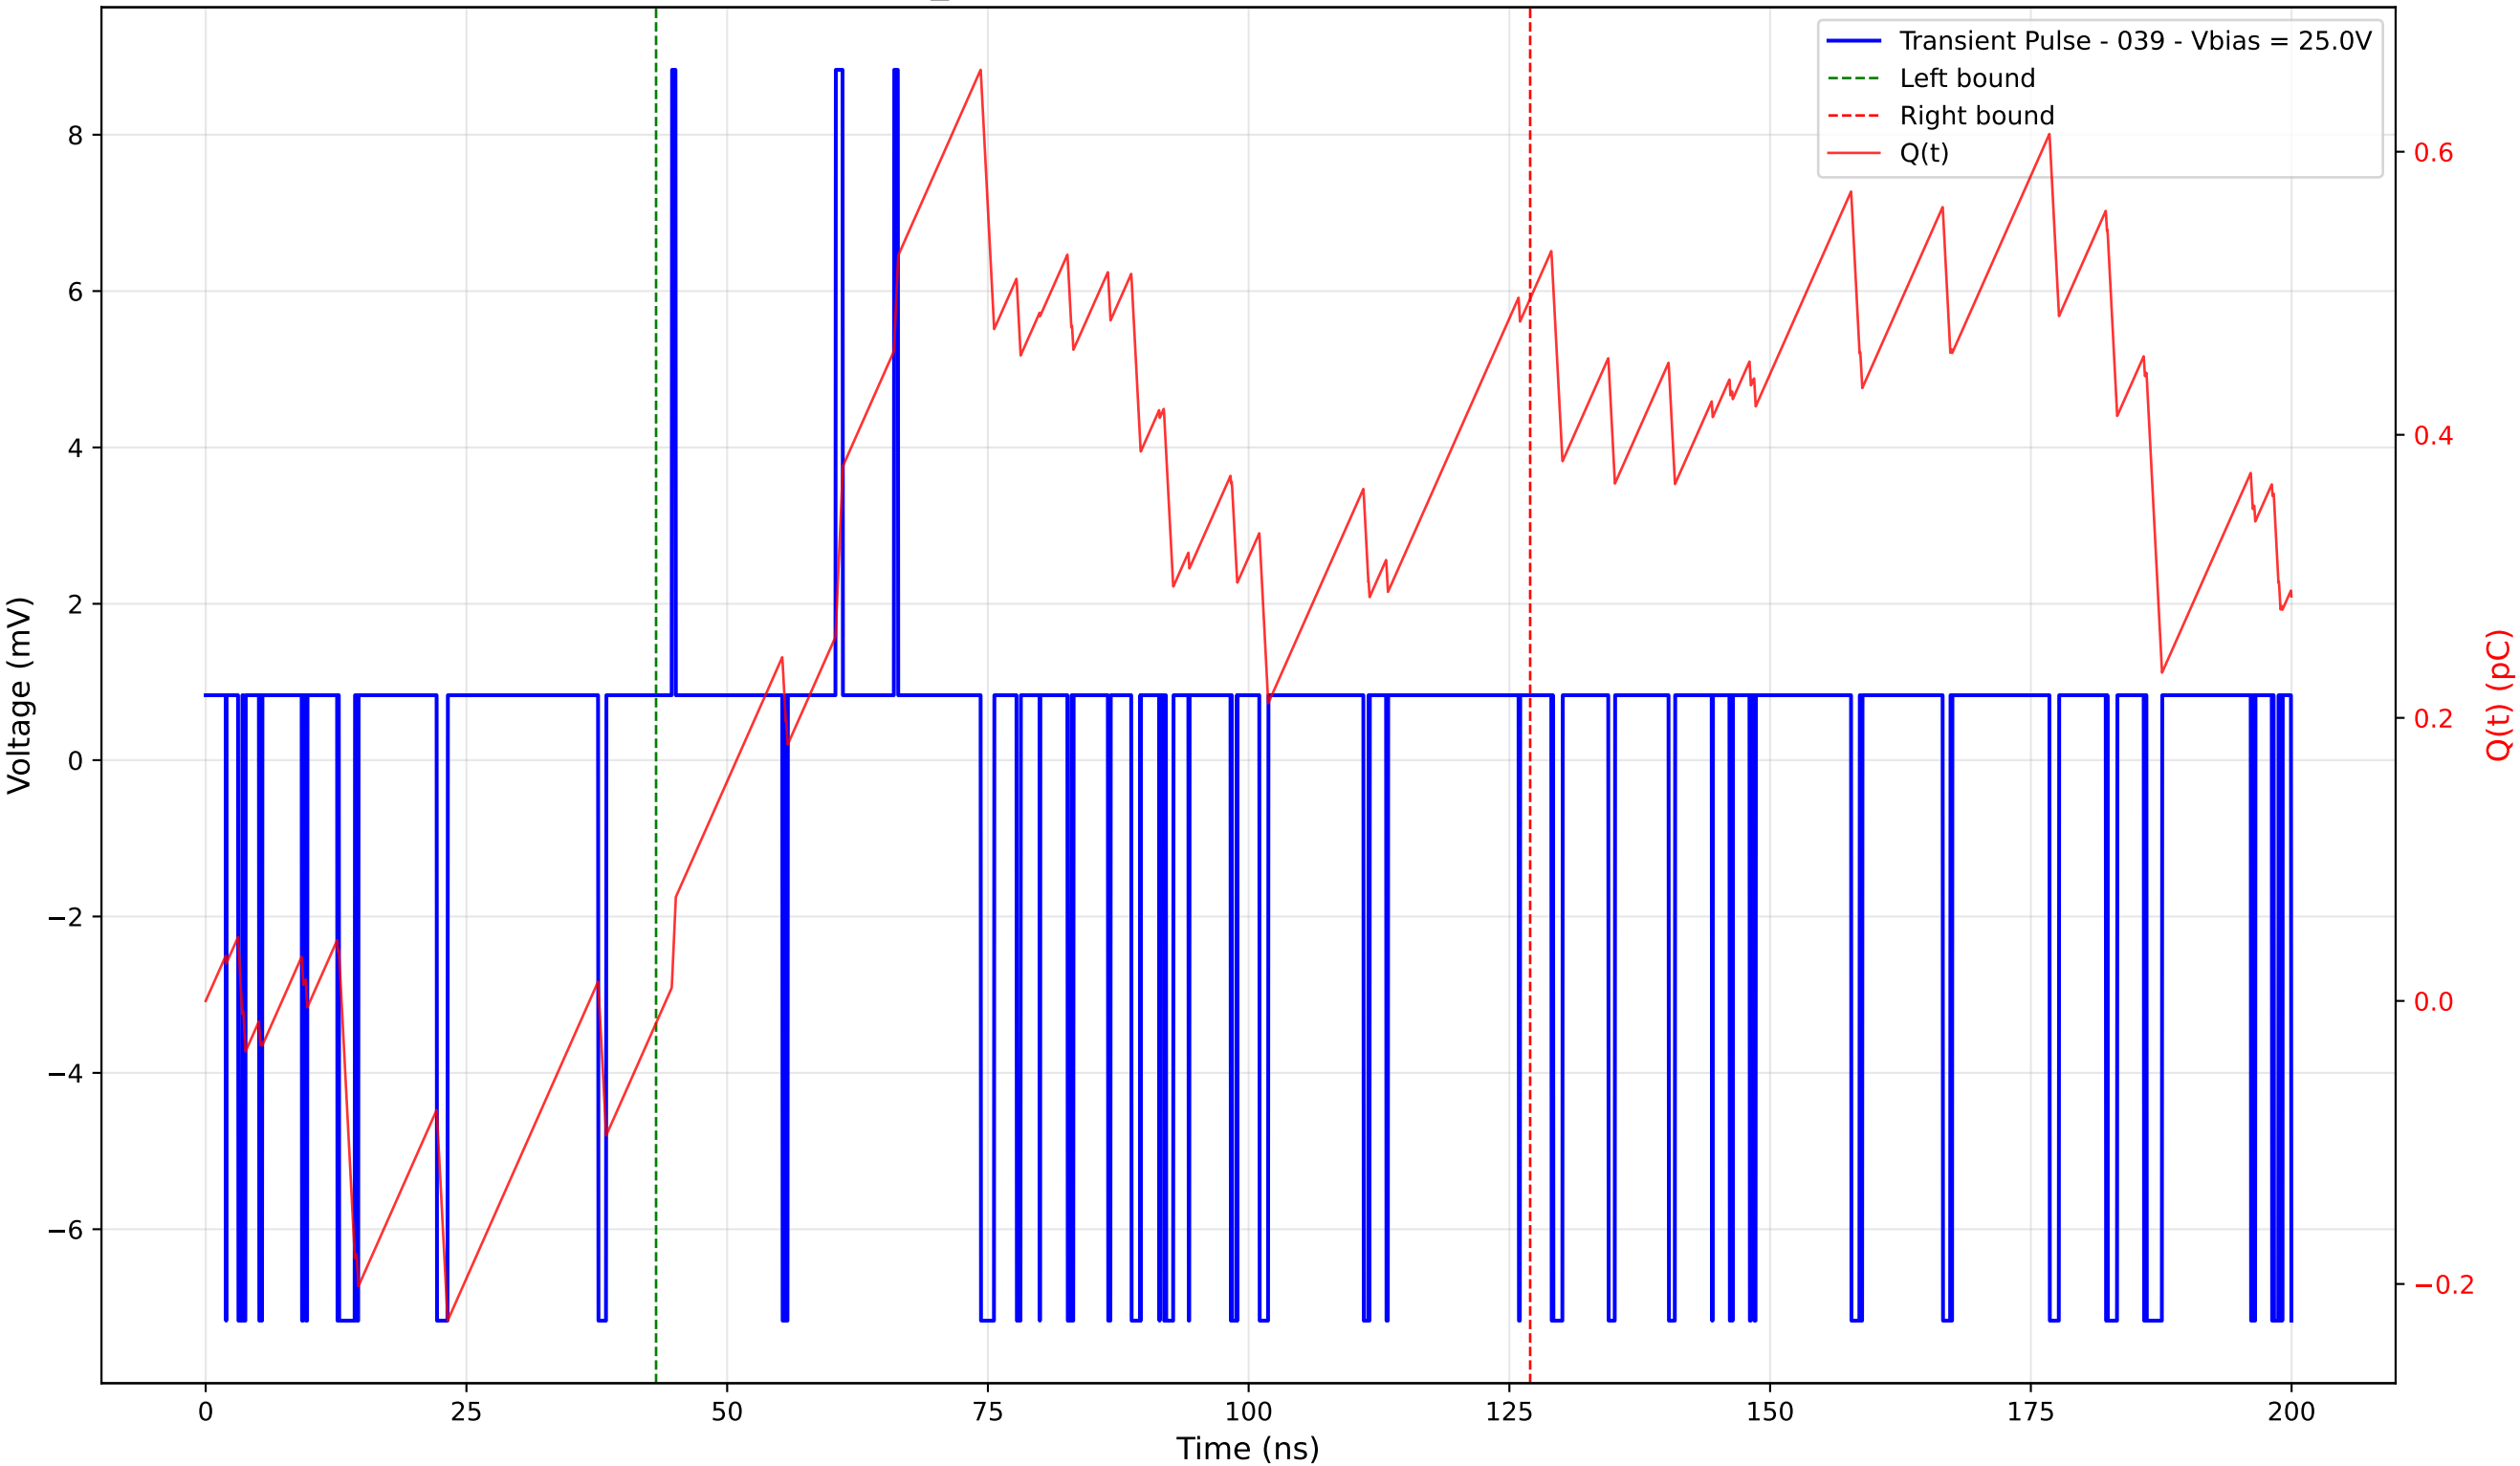


Transient Pulse - Sample: TD_4004 - Position: 20.0 μm - Charge: 0.66 pC - Rise Time: 0.00 ns (N/A)

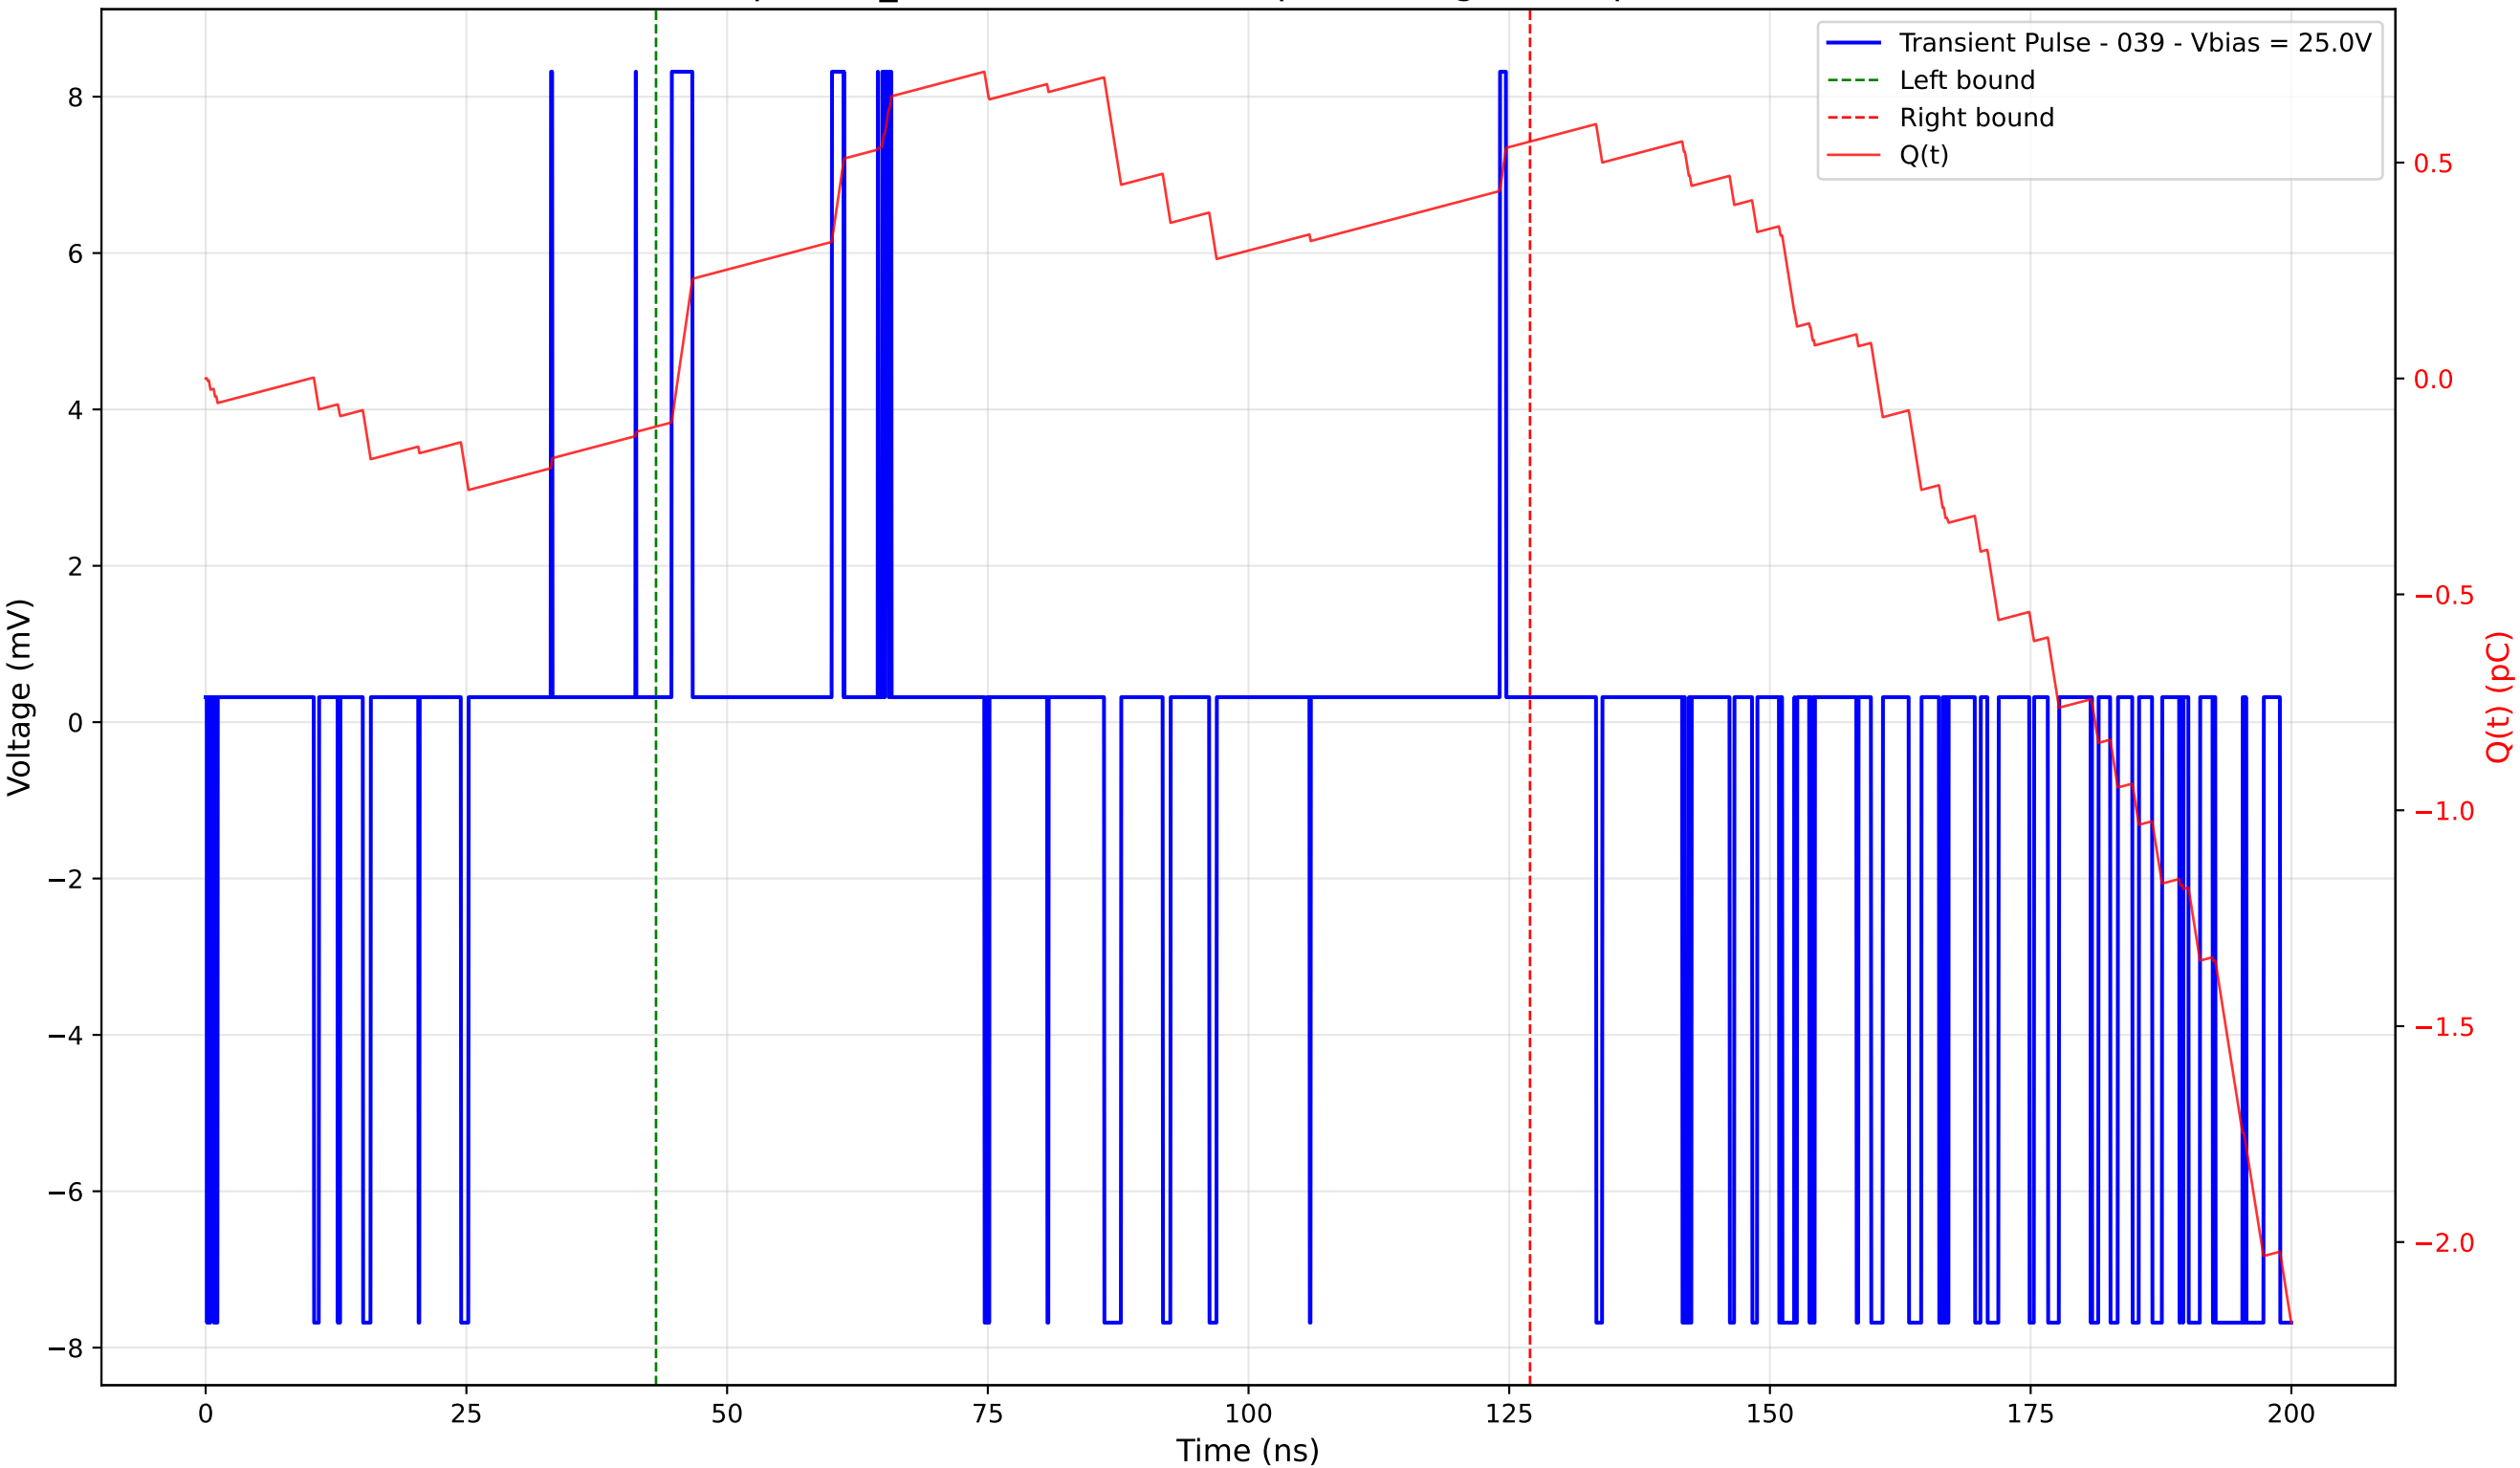


Transient Pulse - Sample: TD_4004 - Position: 25.0 μm - Charge: 6.06 pC - Rise Time: 0.00 ns (N/A)

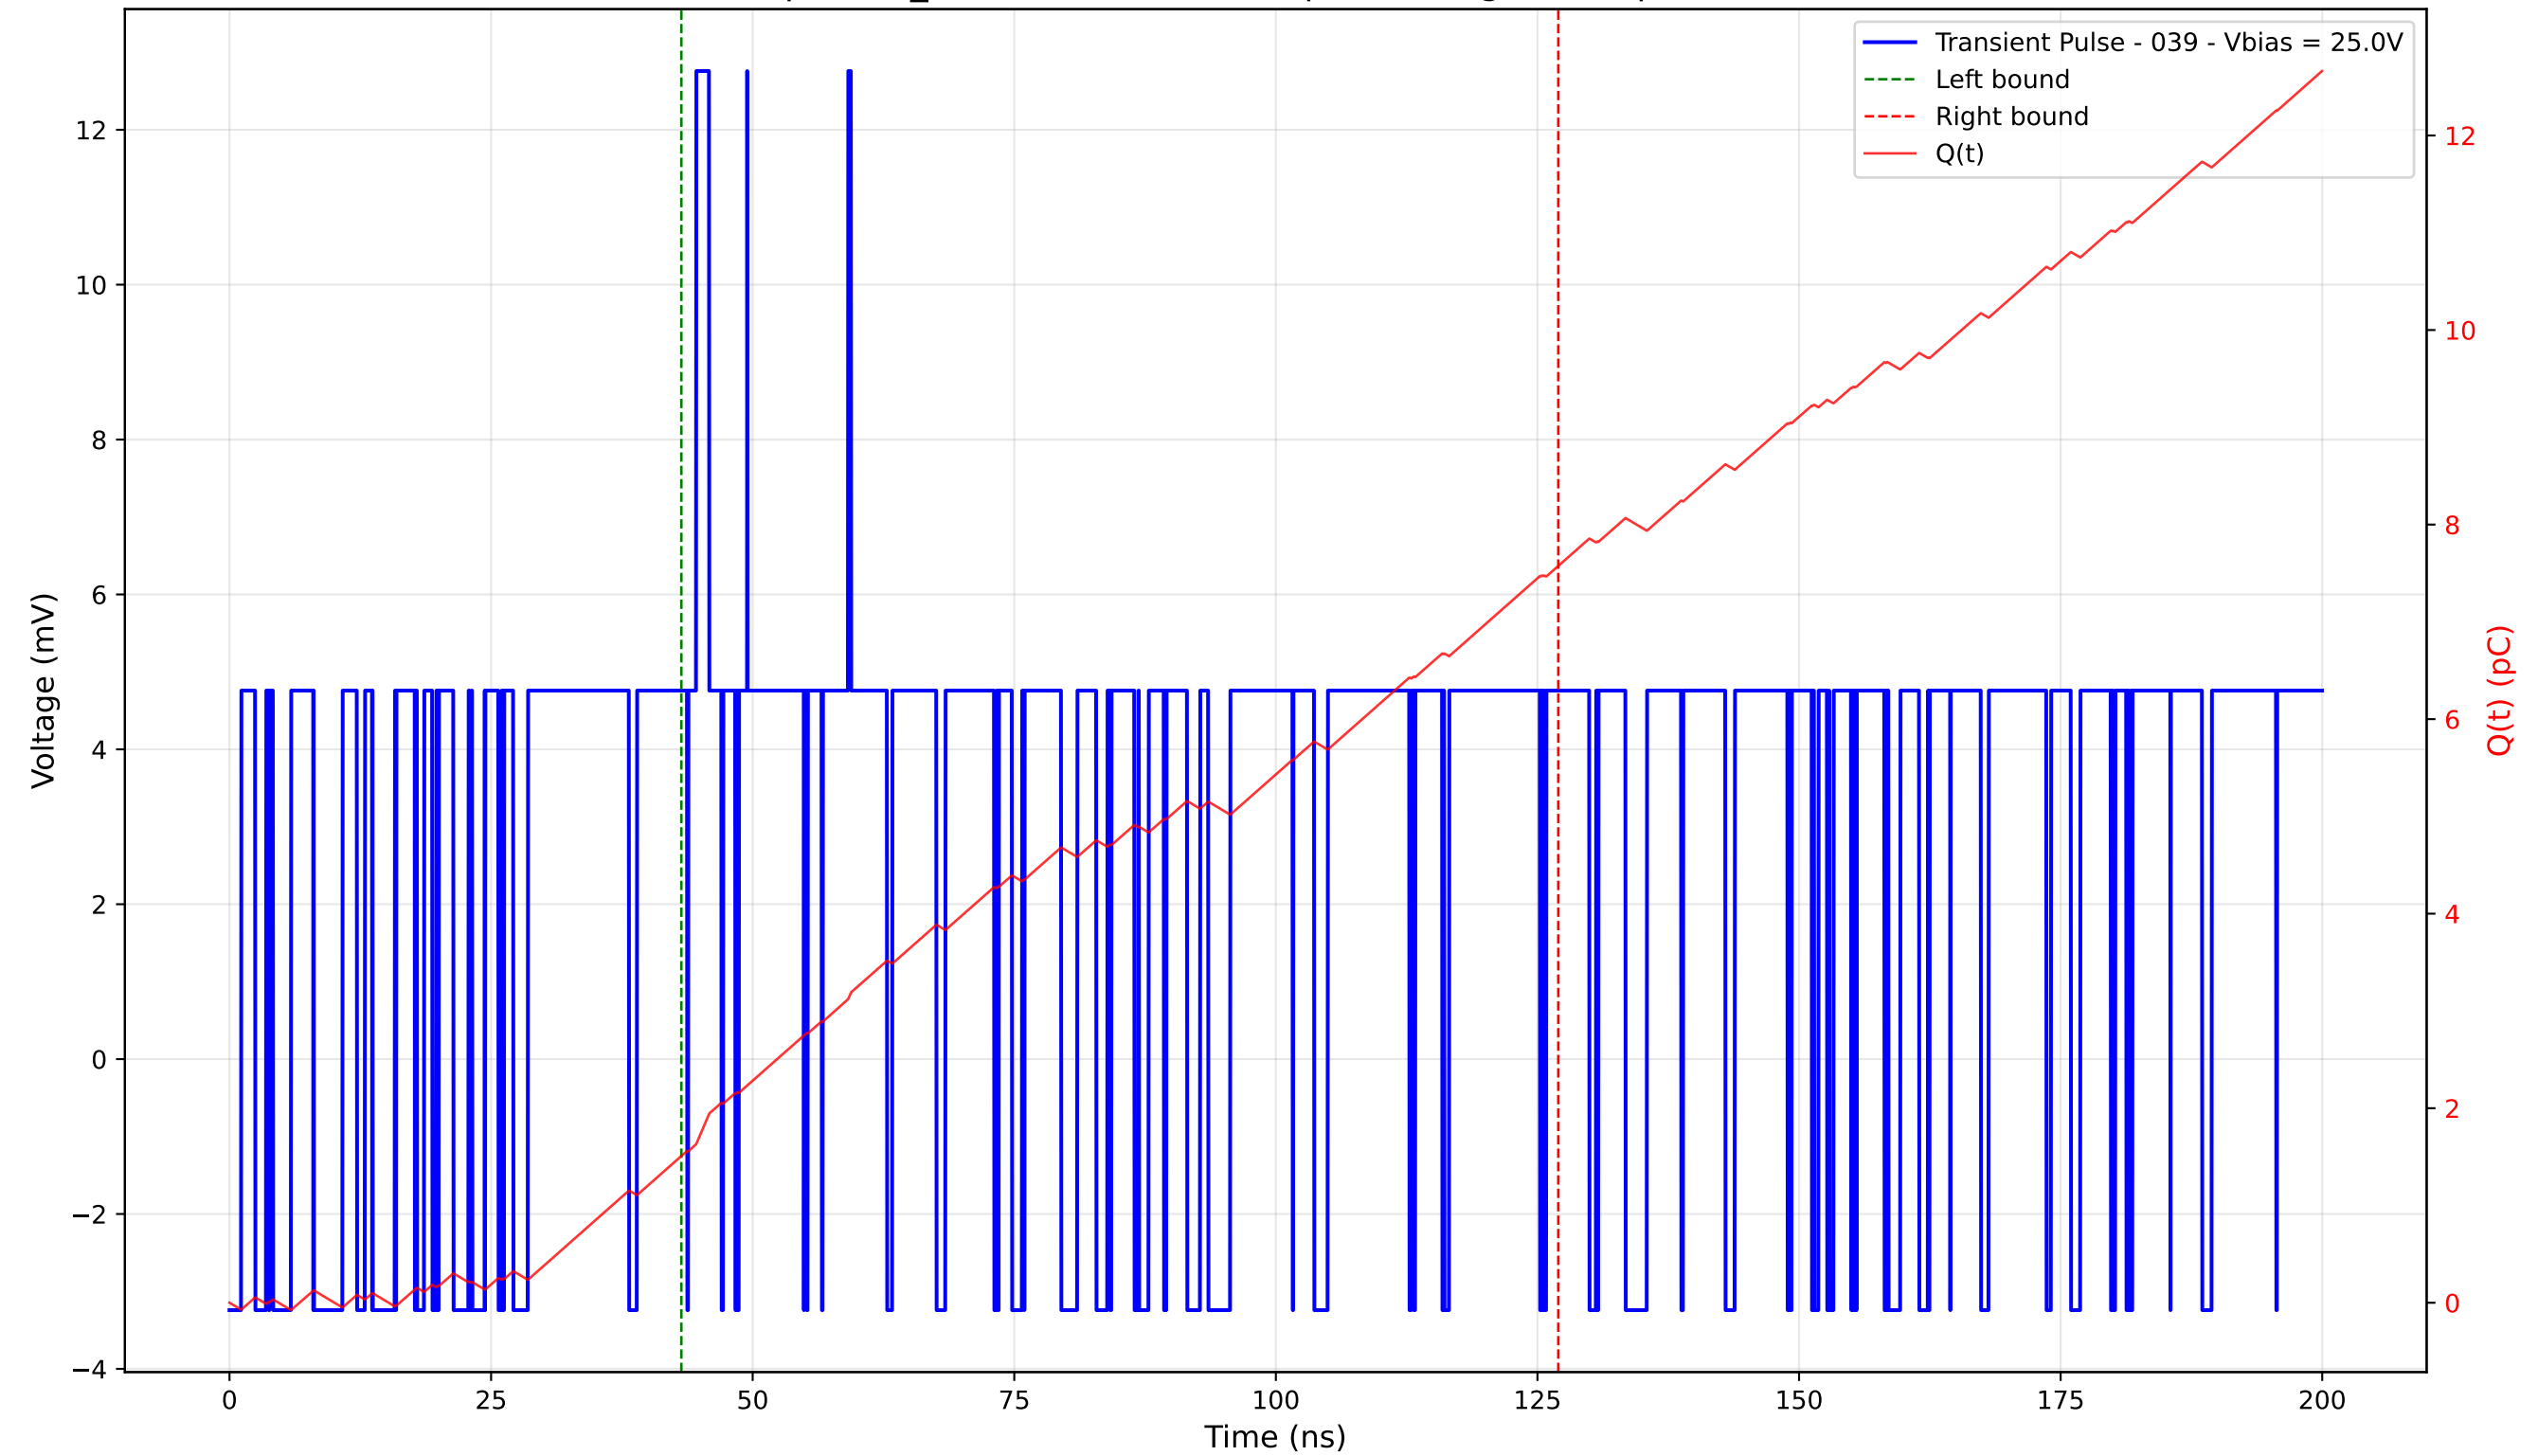


Transient Pulse - Sample: TD_4004 - Position: 30.0 μm - Charge: 3.93 pC - Rise Time: 0.00 ns (N/A)

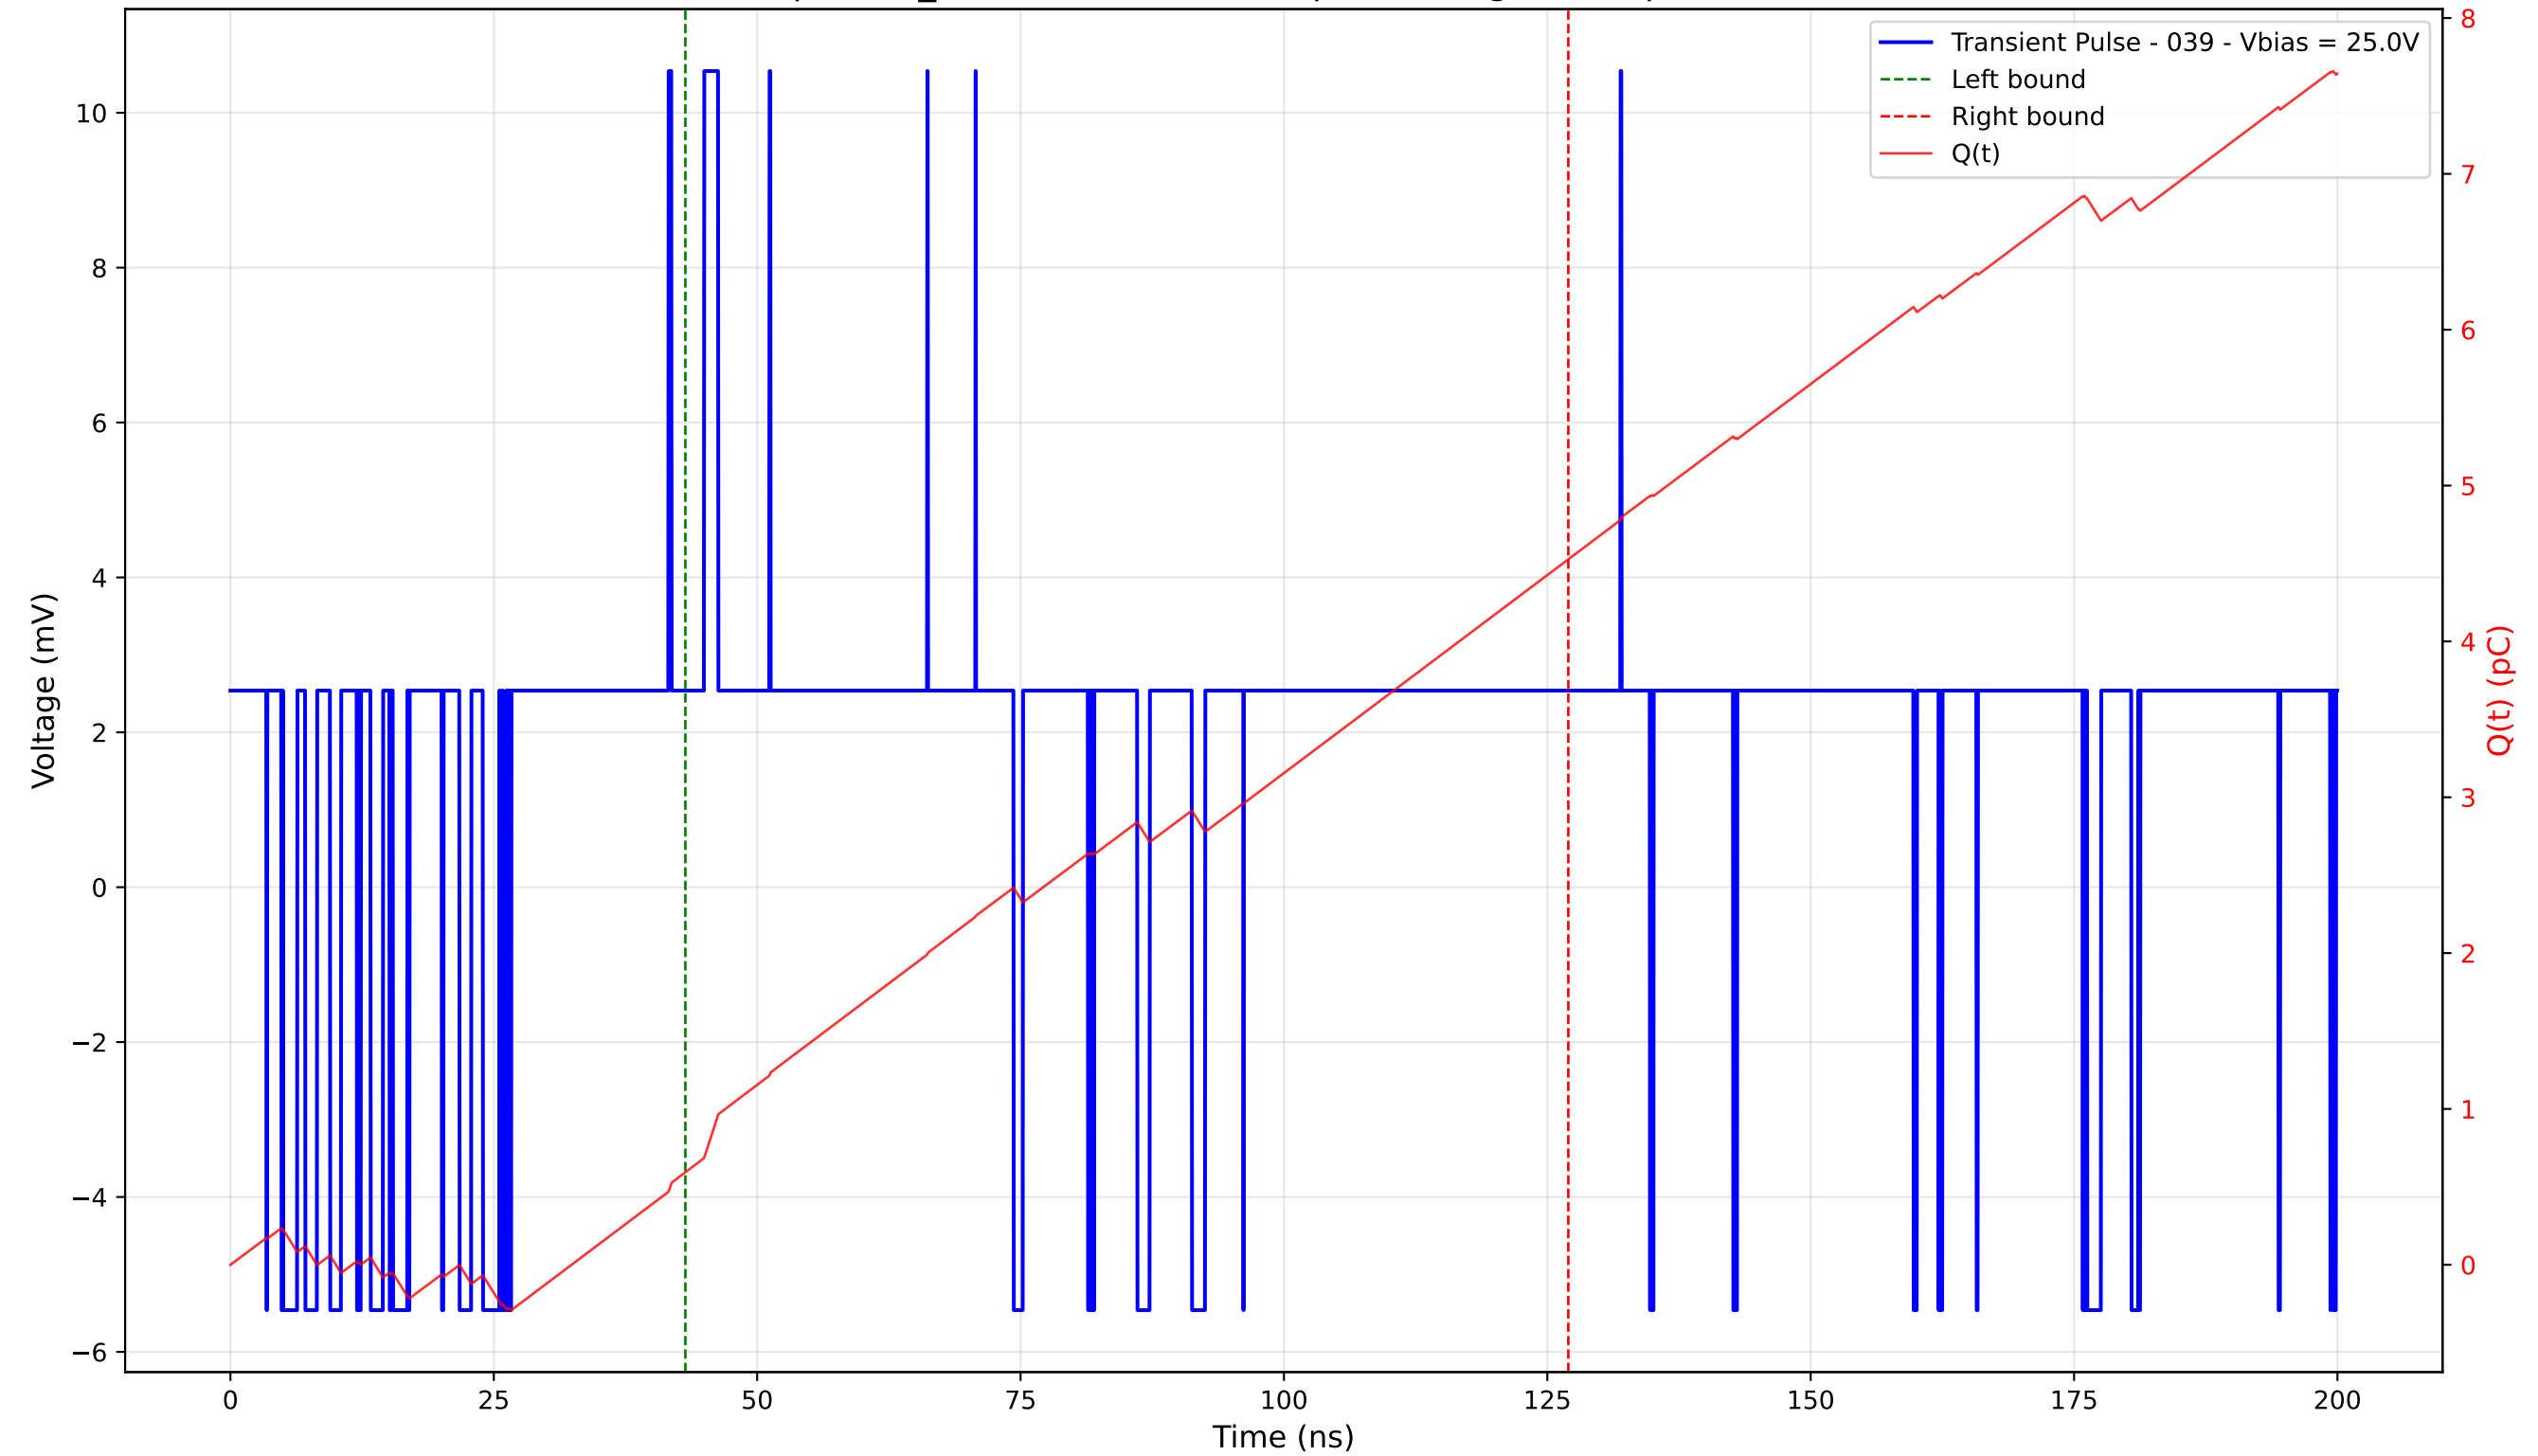


Transient Pulse - Sample: TD_4004 - Position: 35.0 μm - Charge: 9.92 pC - Rise Time: 1.66 ns

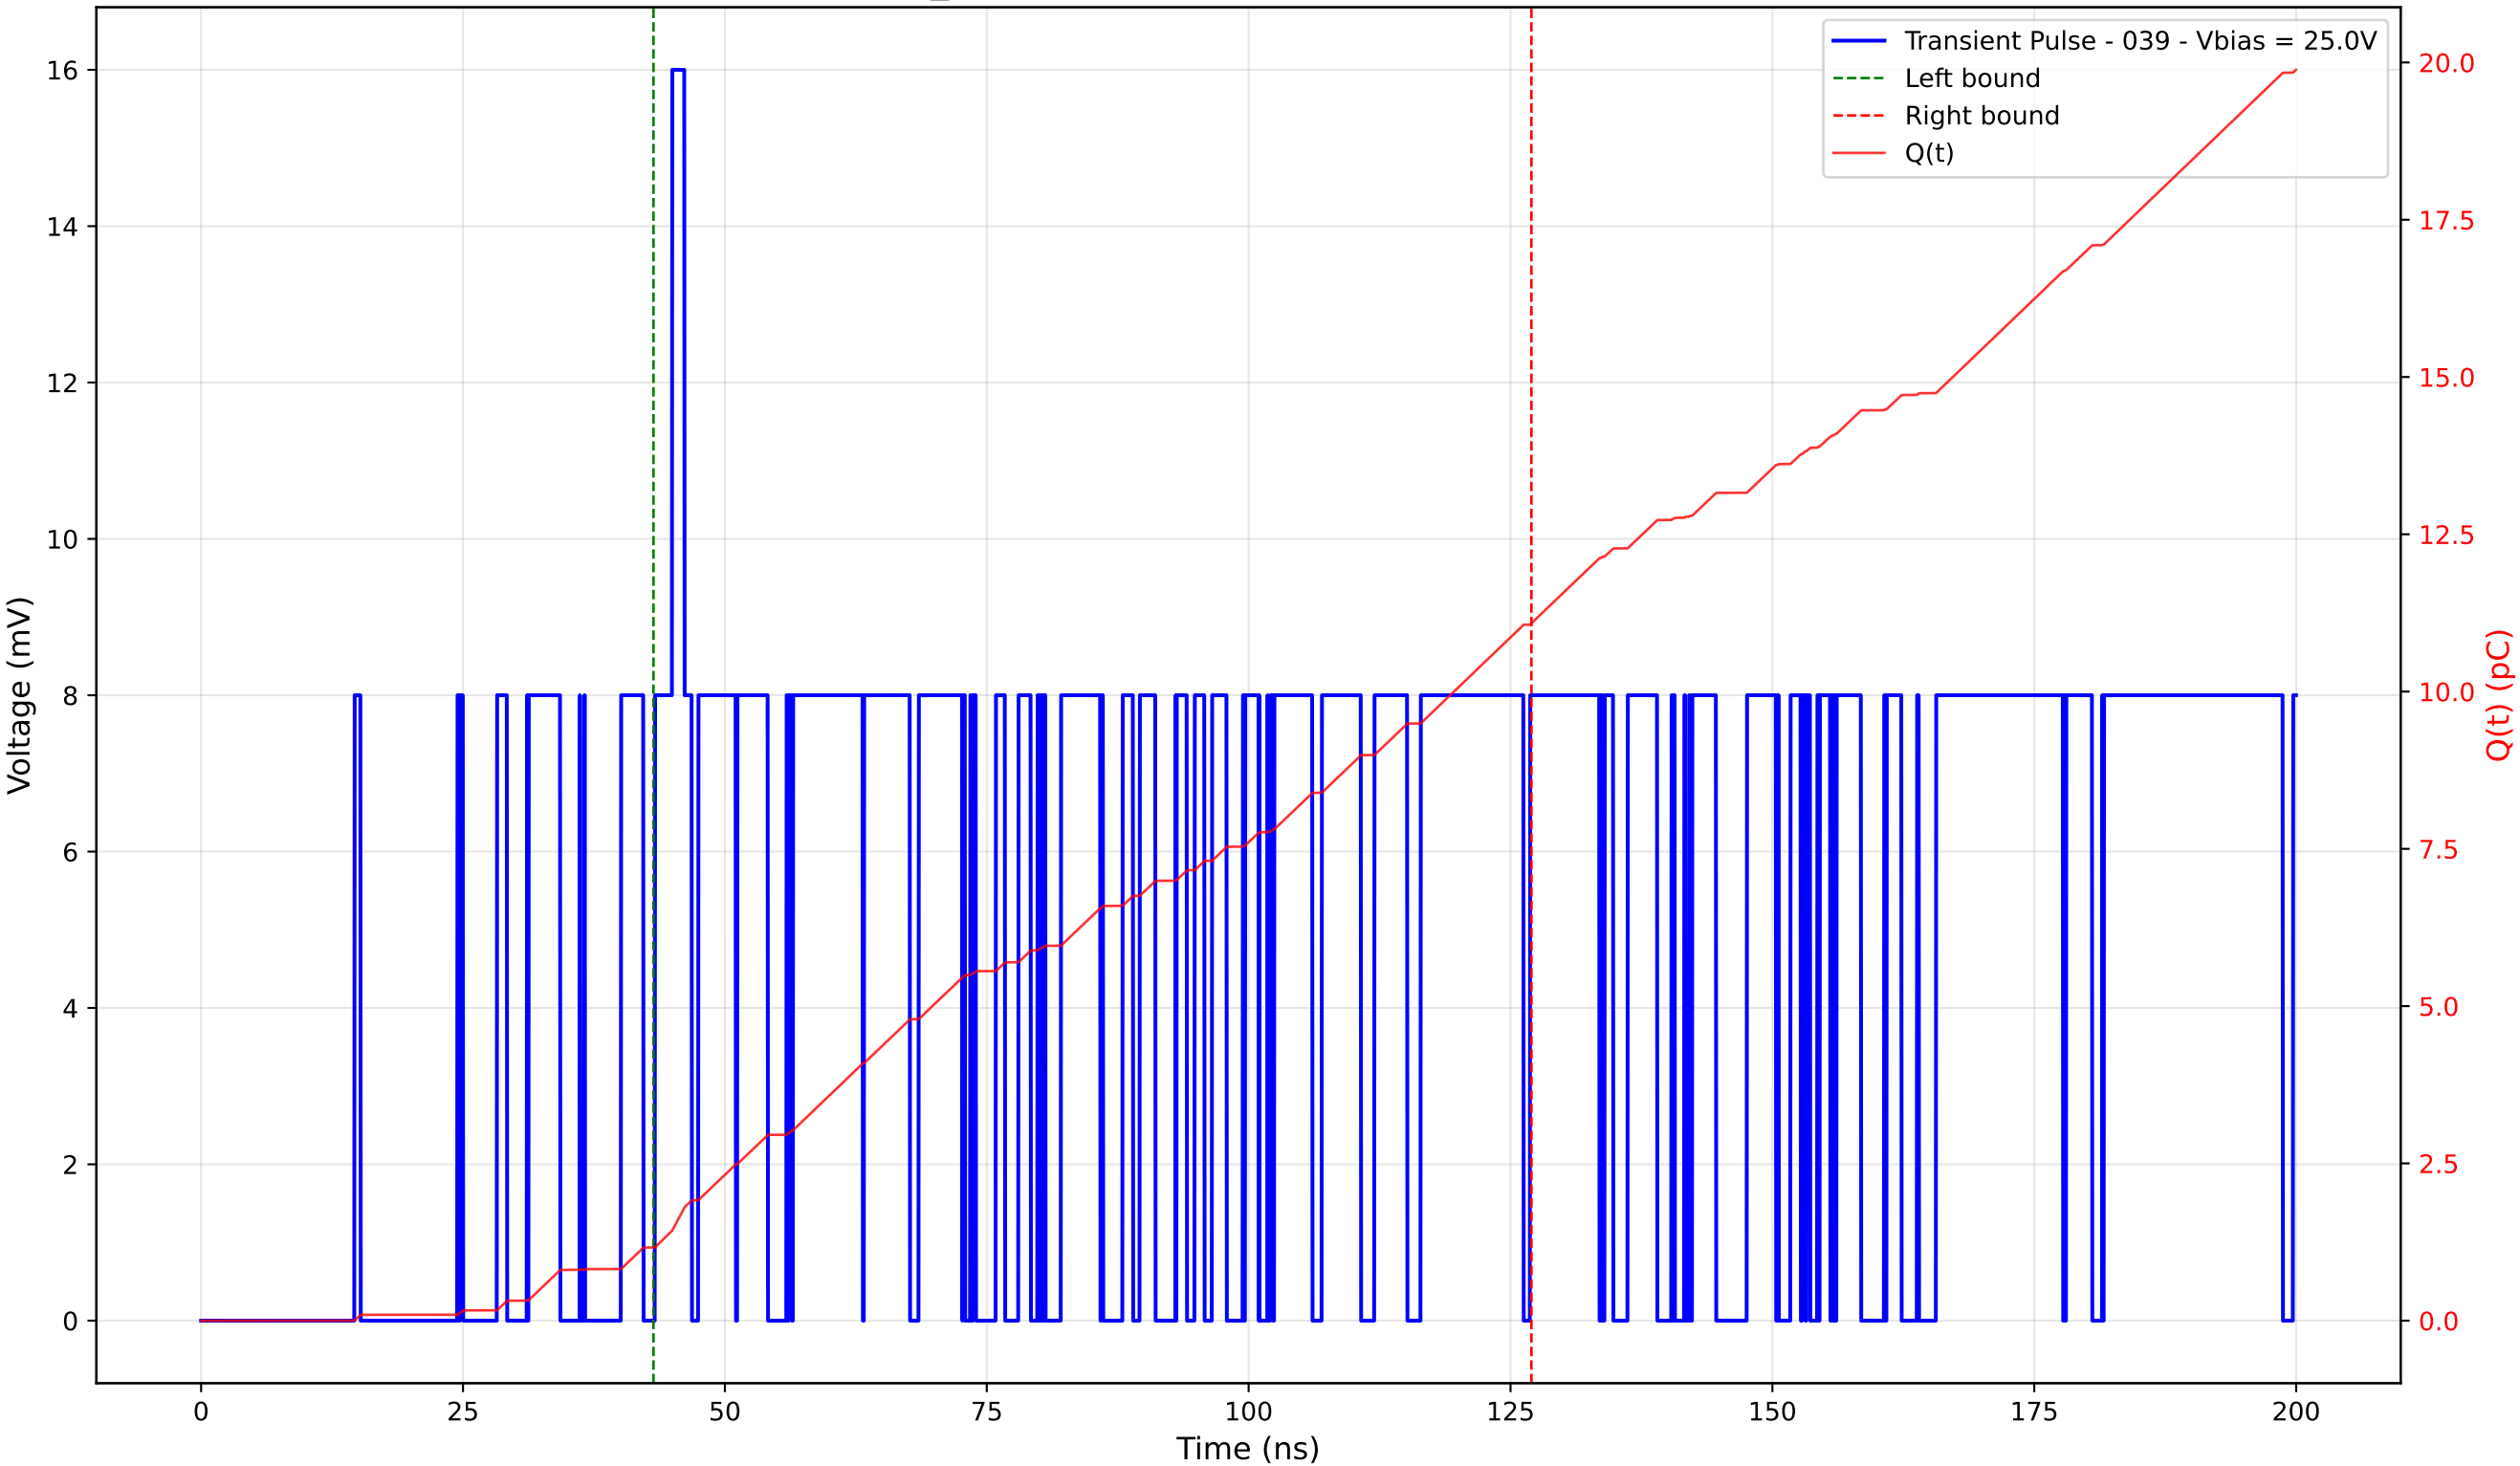


Transient Pulse - Sample: TD_4004 - Position: 40.0 μm - Charge: 4.08 pC - Rise Time: 0.00 ns (N/A)

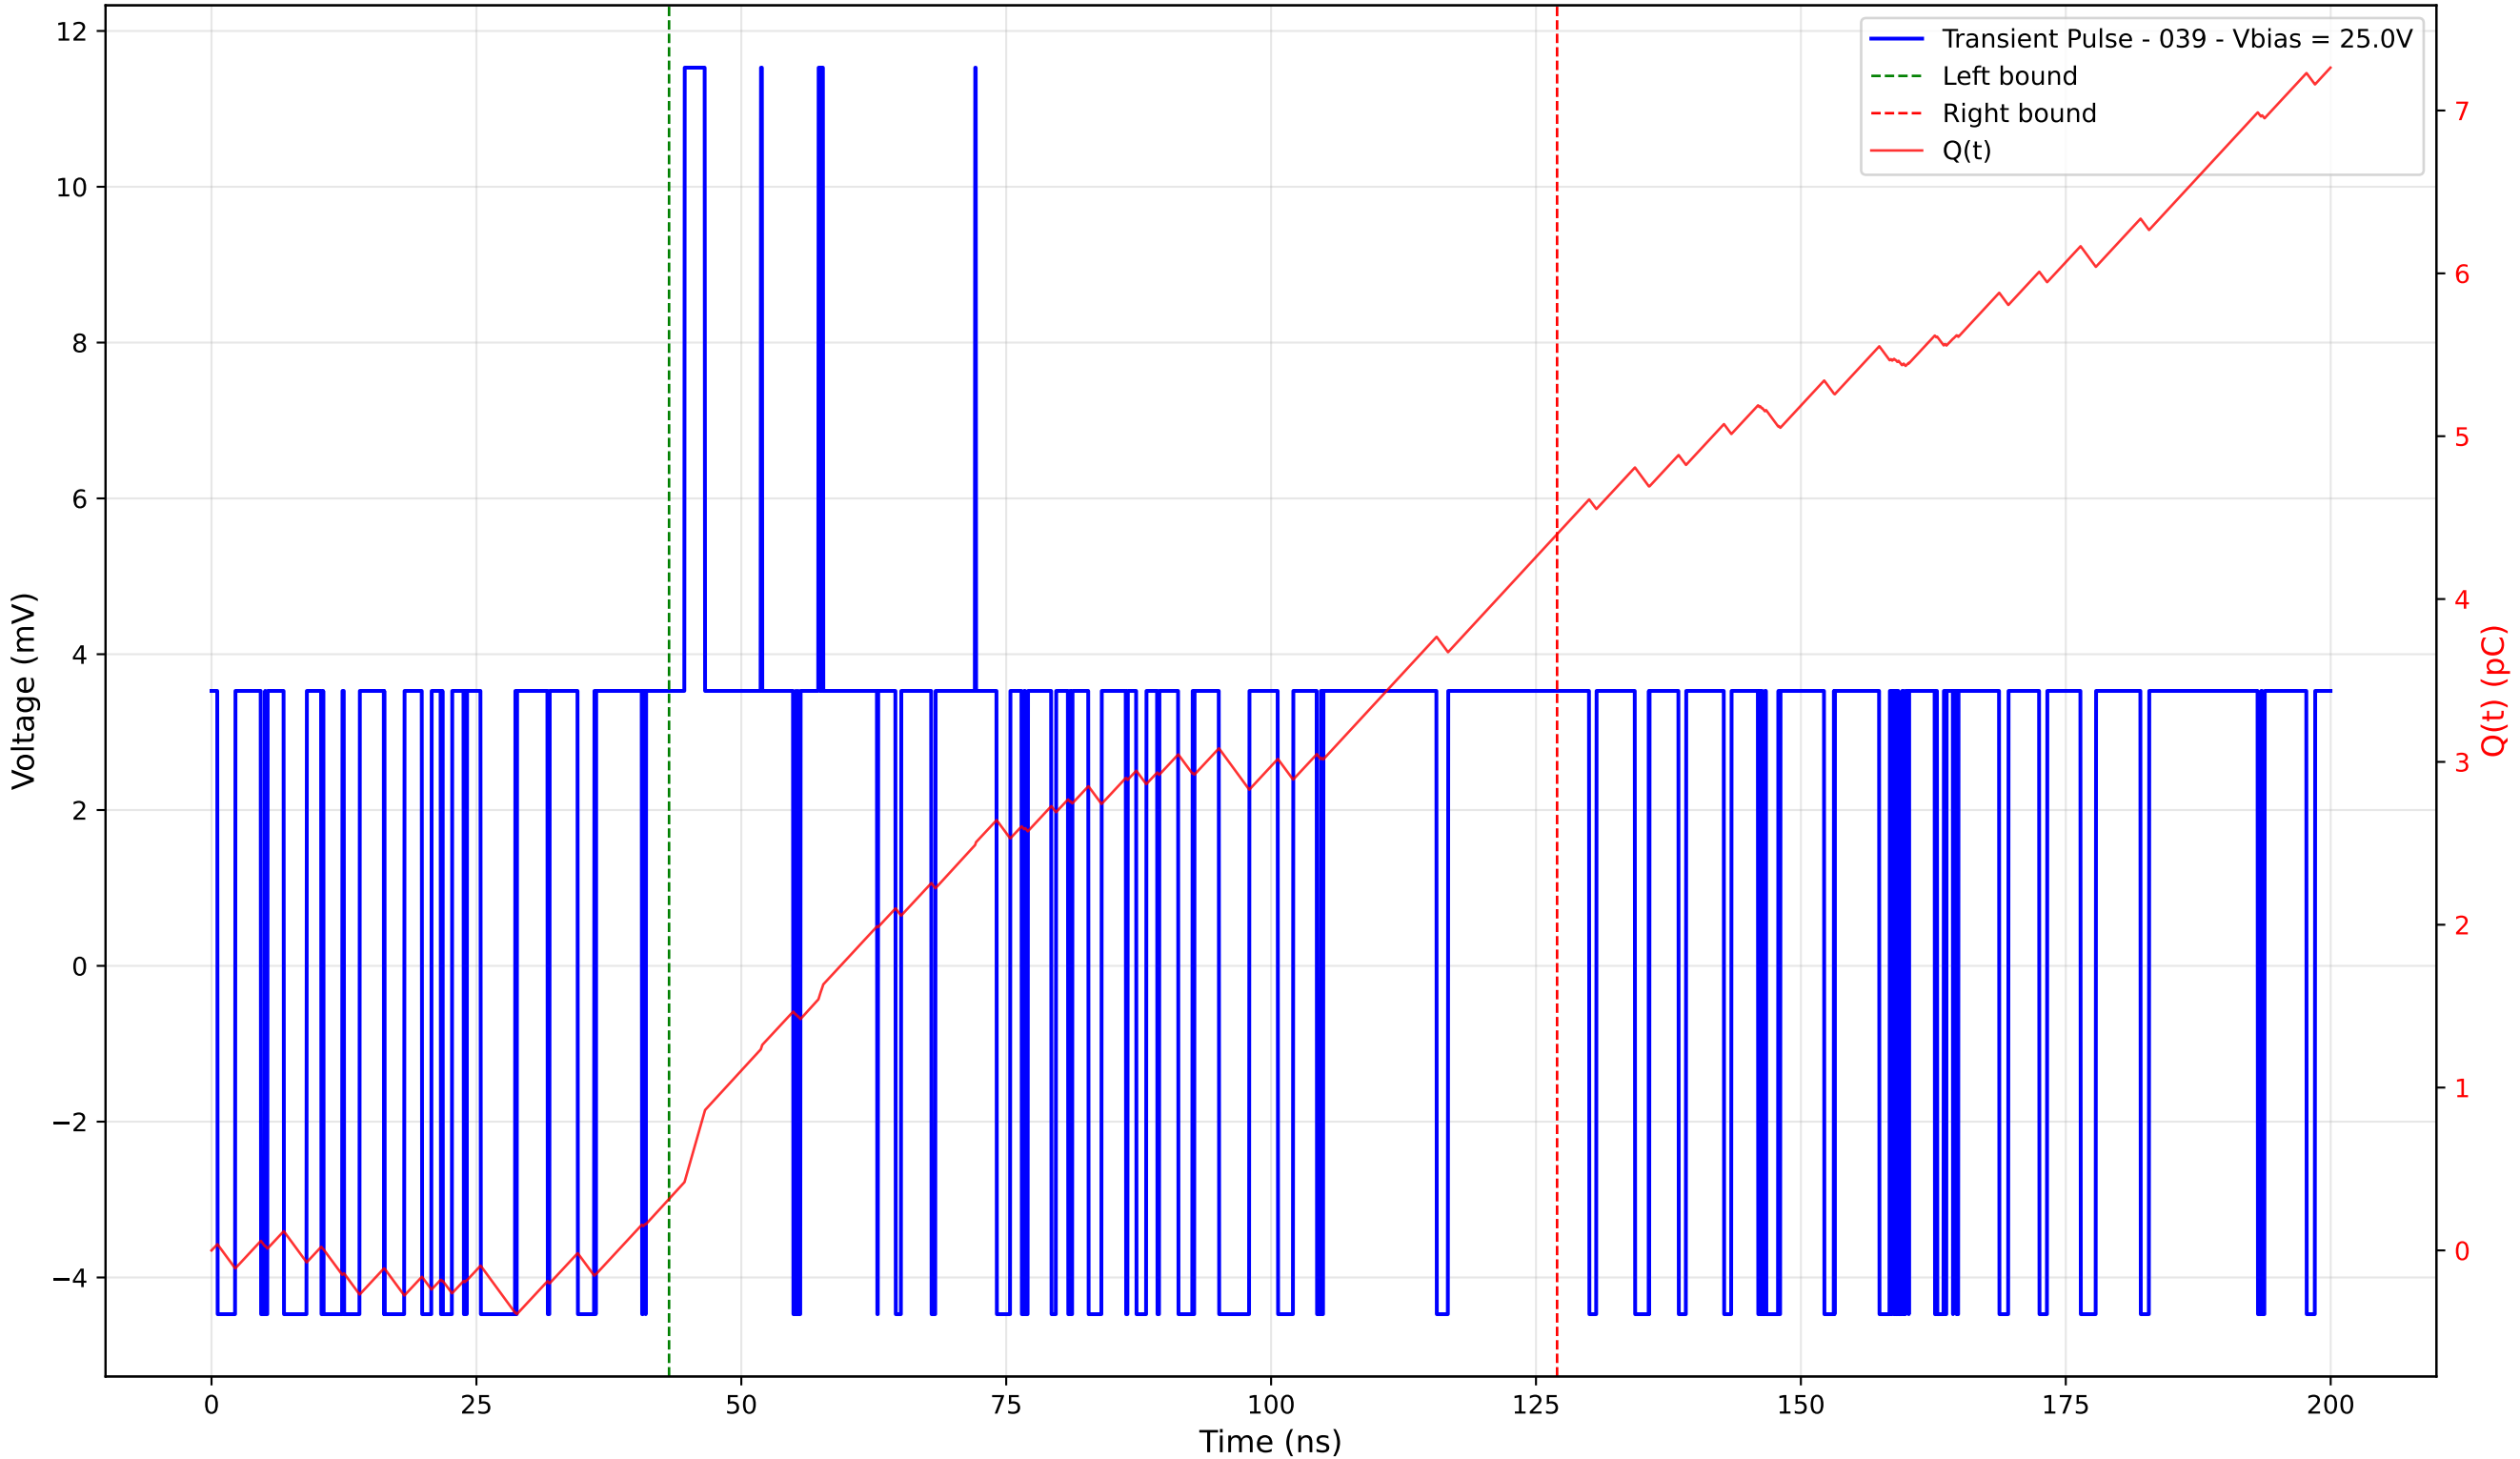


Transient Pulse - Sample: TD_4004 - Position: 45.0 μm - Charge: 6.56 pC - Rise Time: 0.00 ns (N/A)

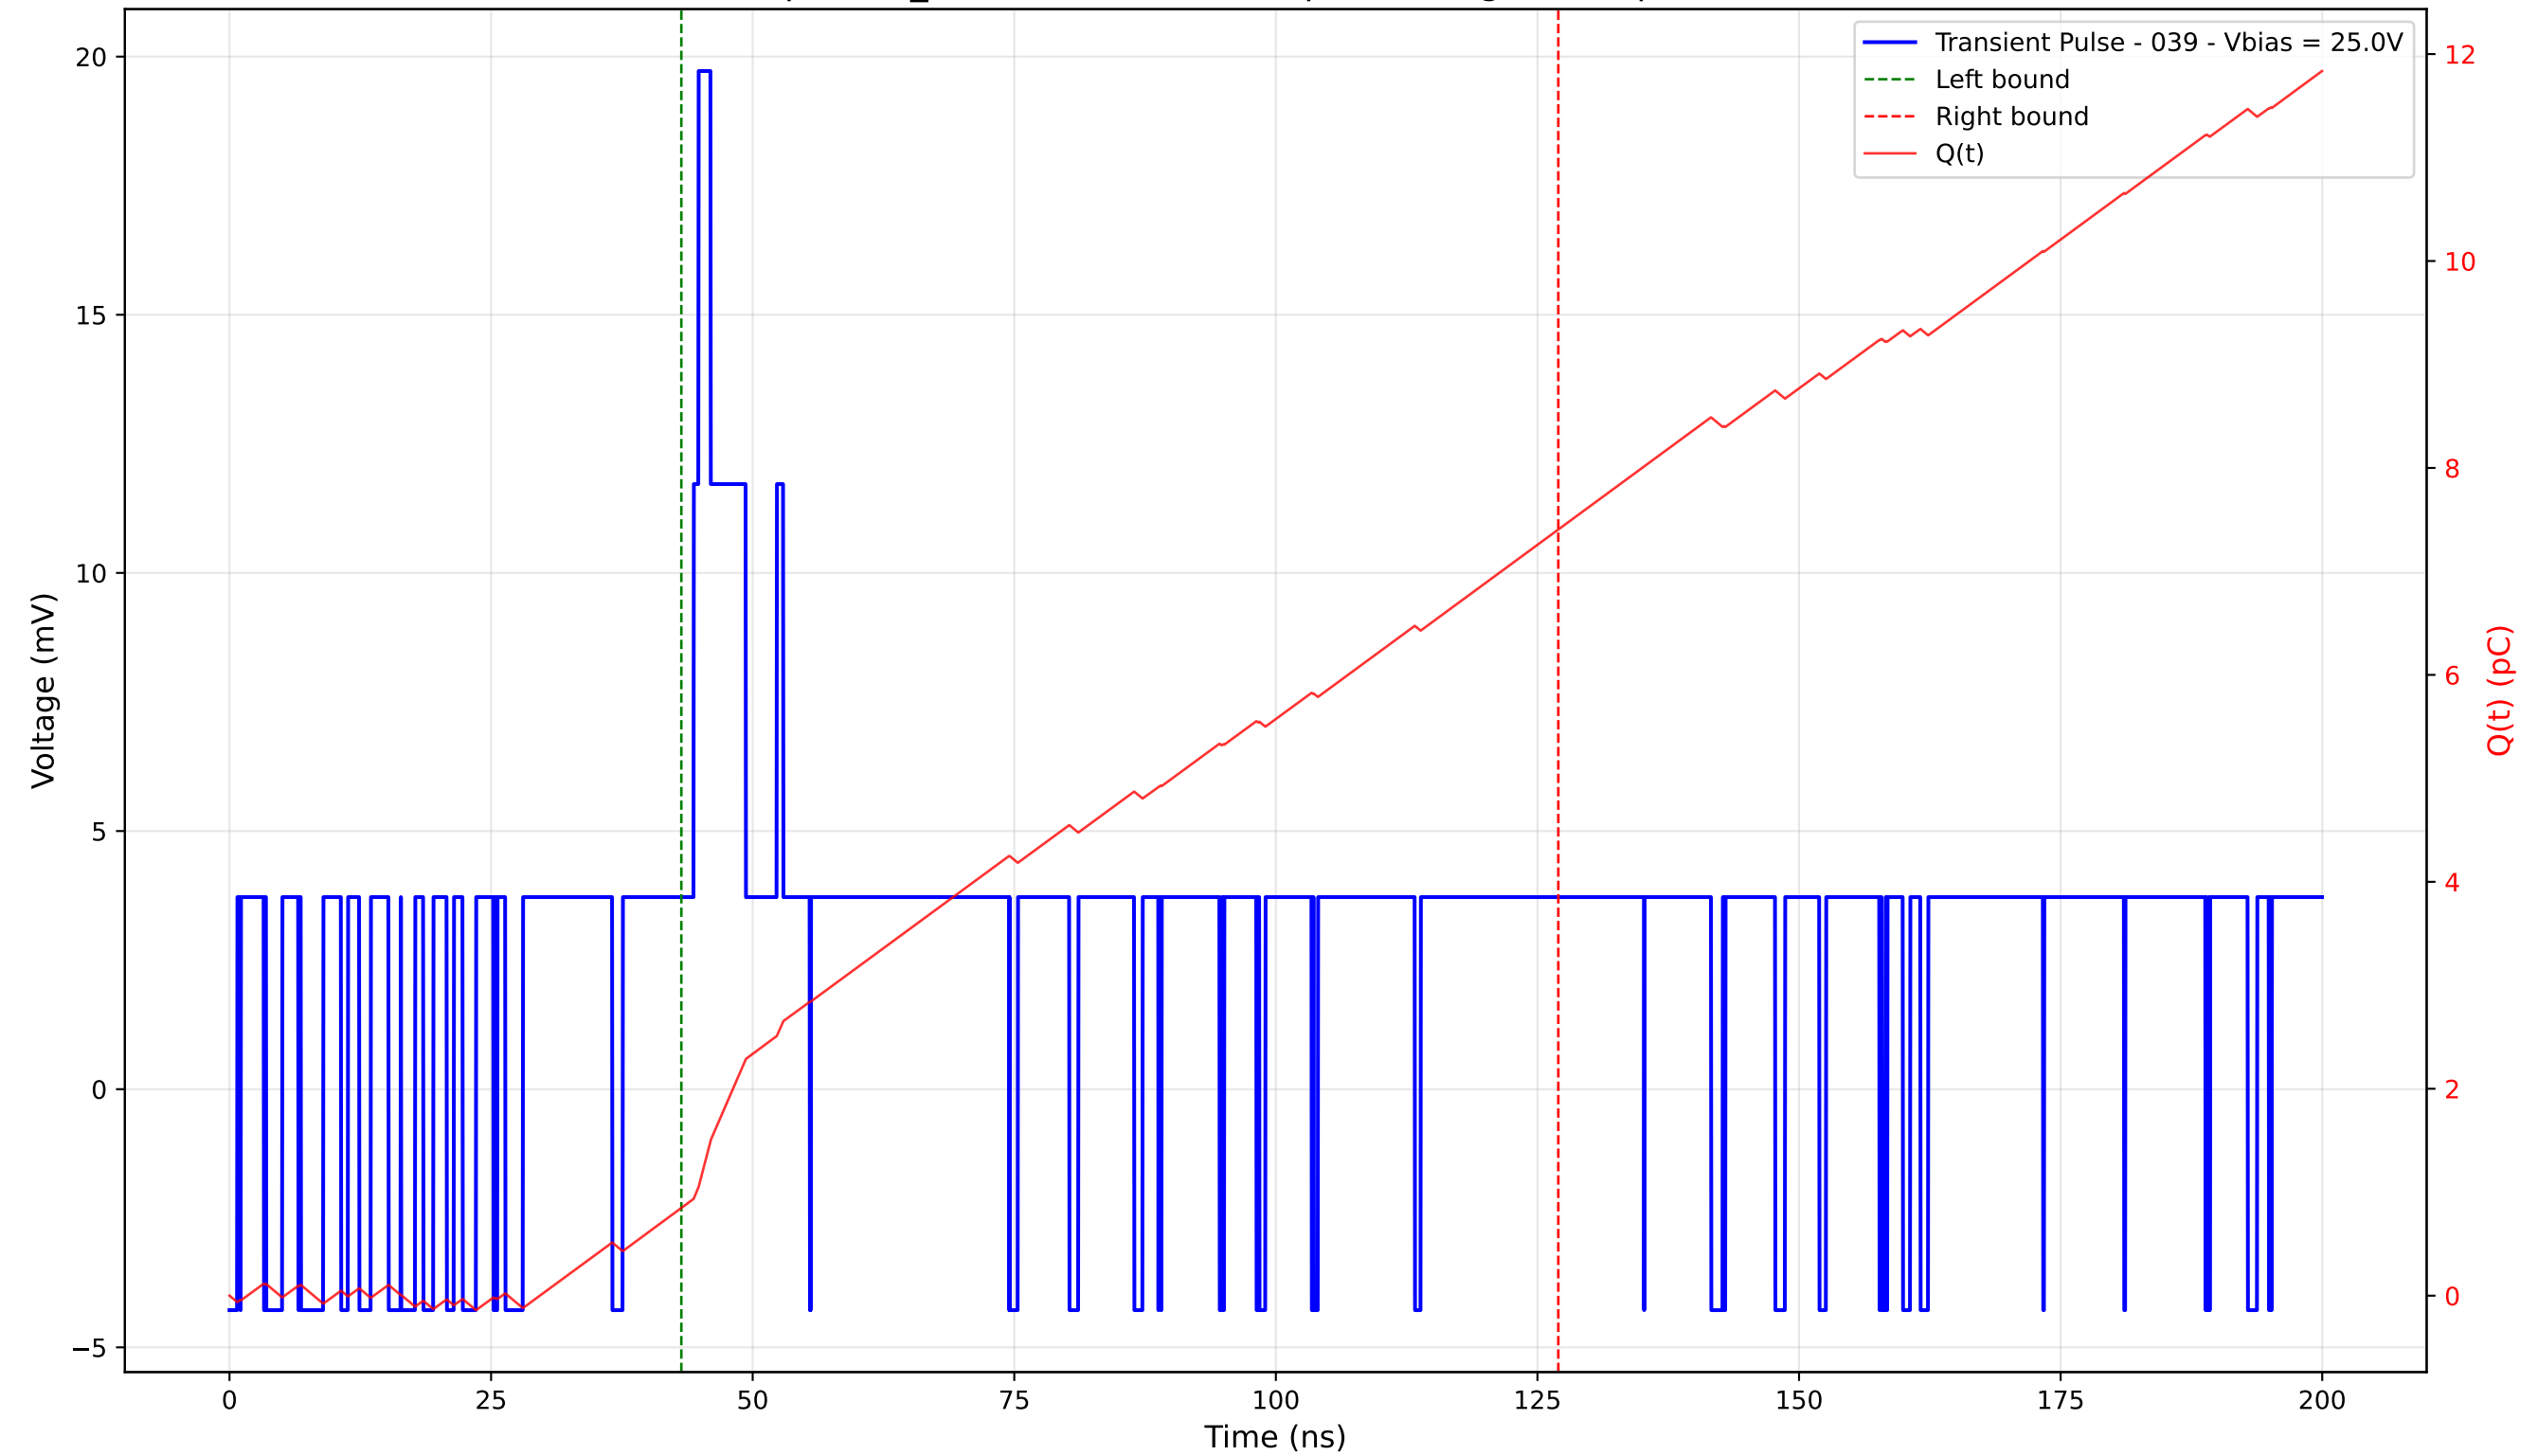


Transient Pulse - Sample: TD_4004 - Position: 50.0 μm - Charge: 1.61 pC - Rise Time: 0.94 ns

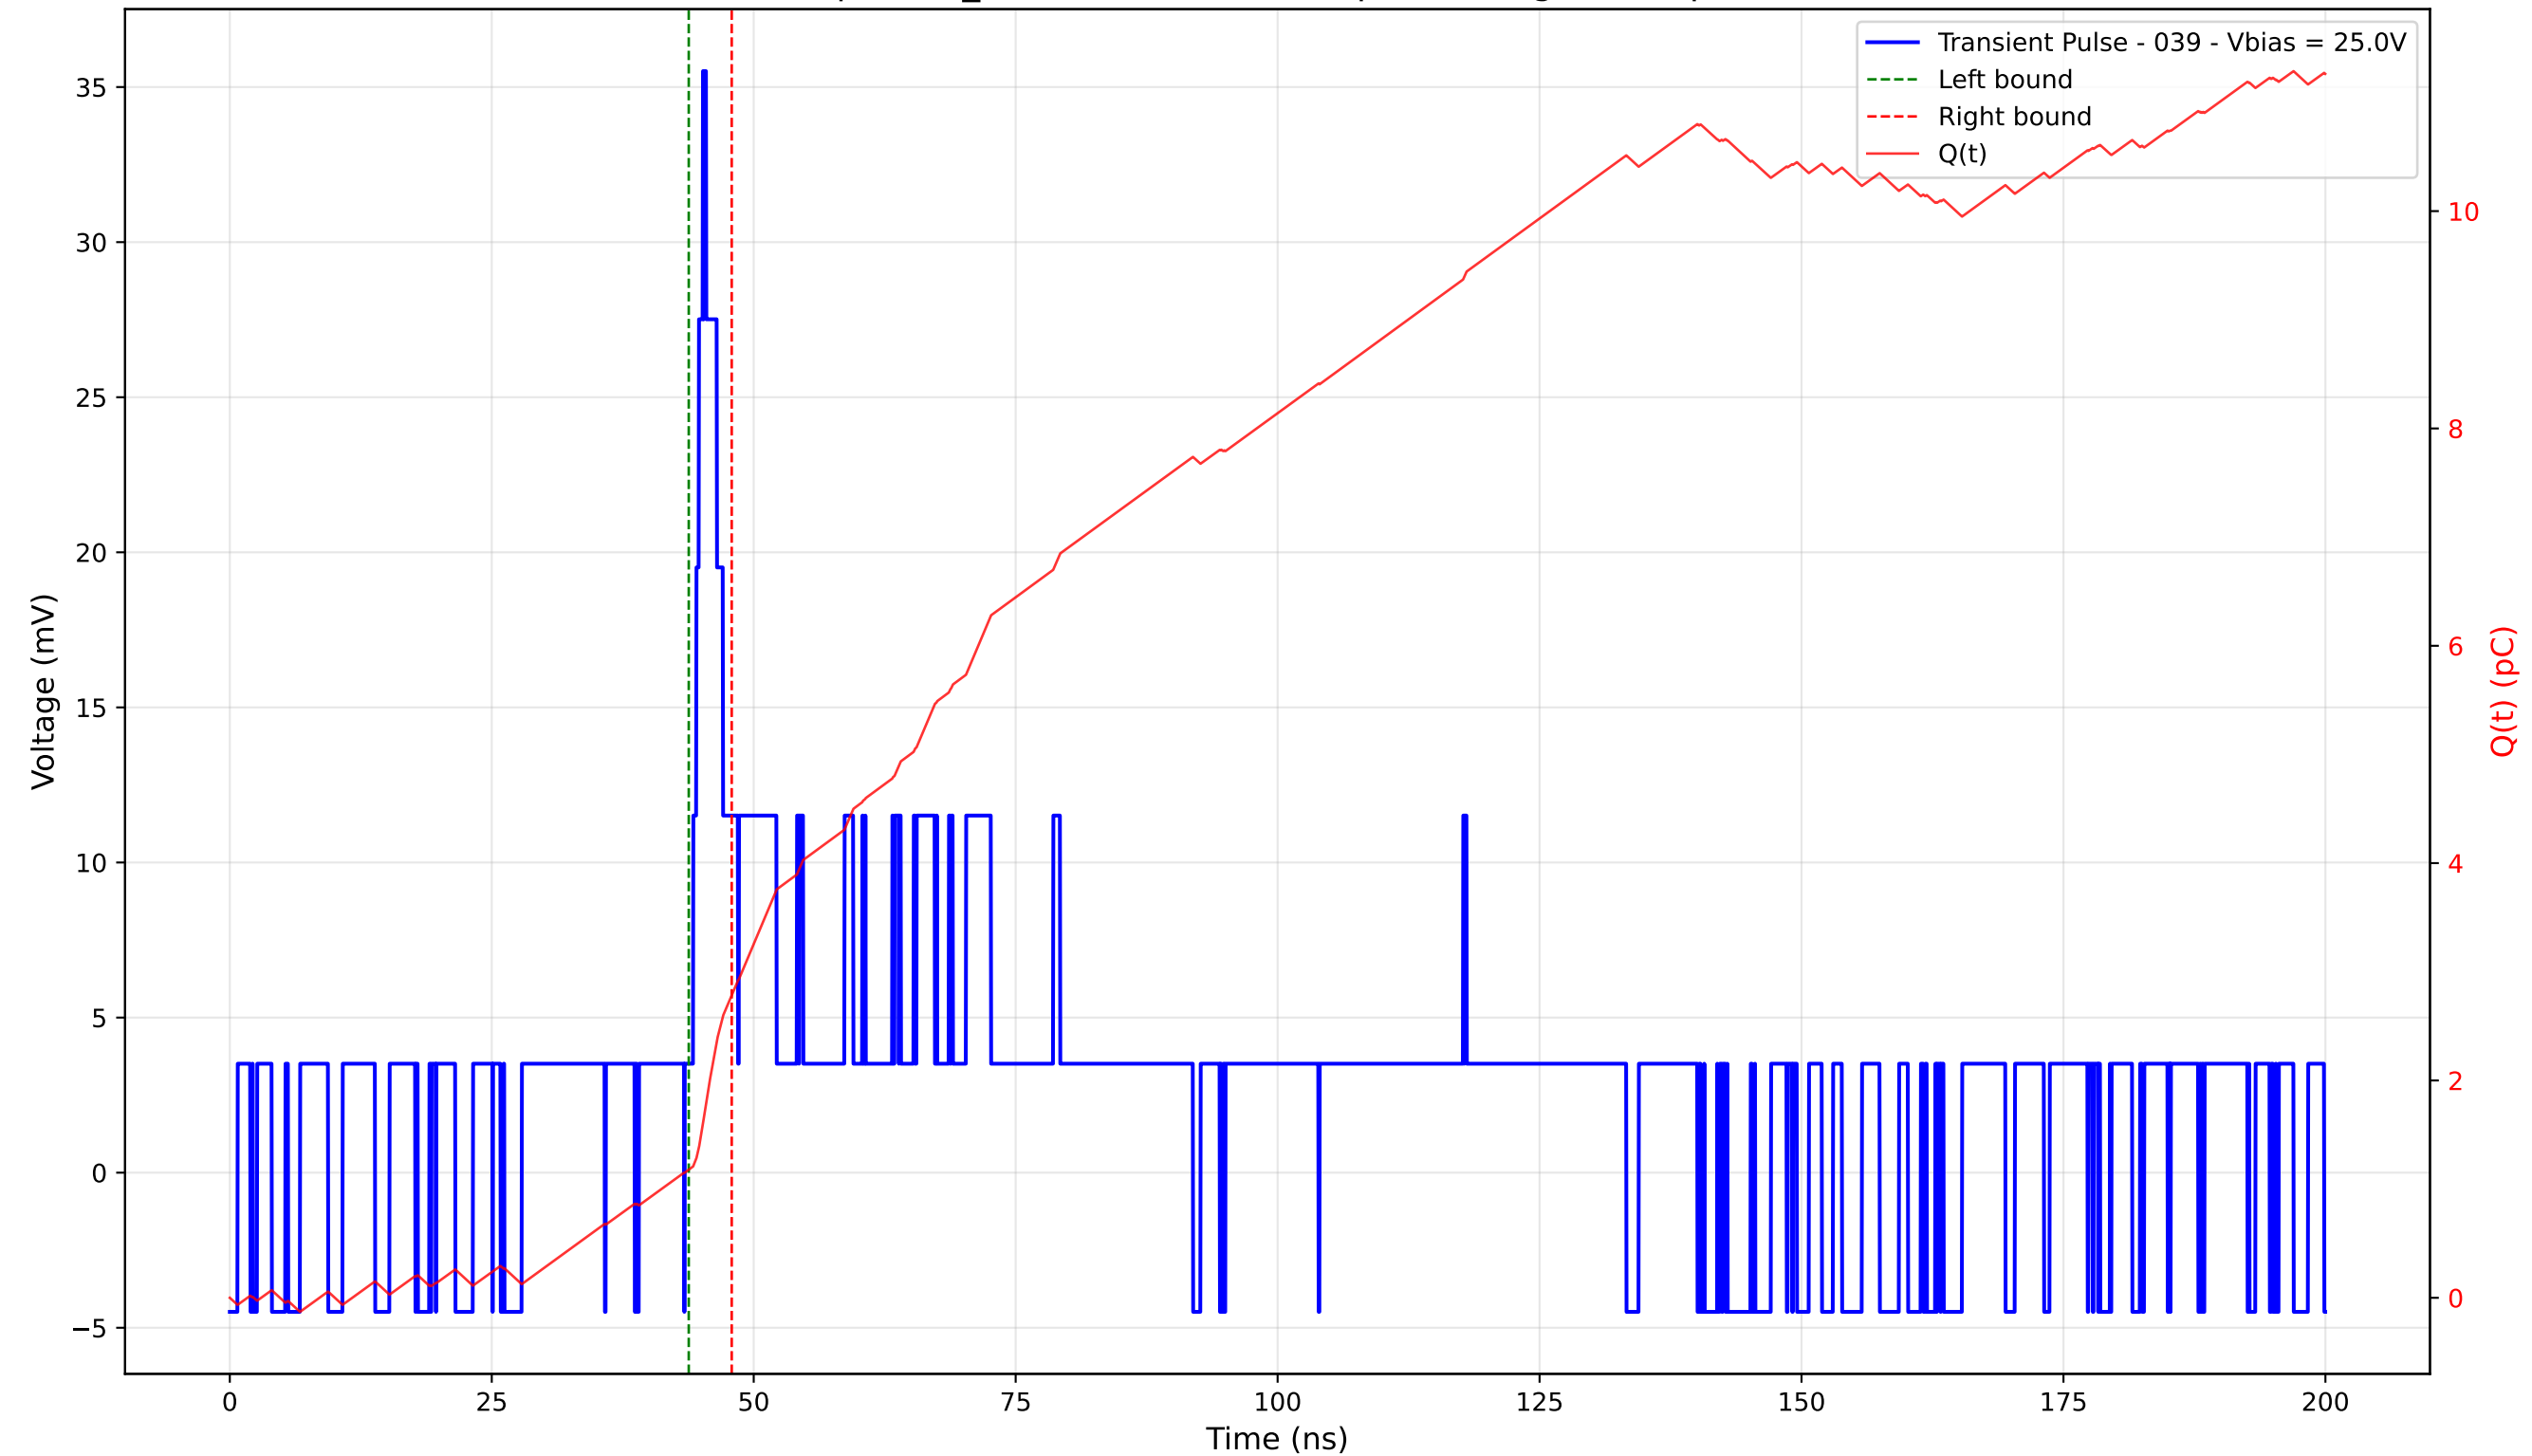


Transient Pulse - Sample: TD_4004 - Position: 55.0 μm - Charge: 4.06 pC - Rise Time: 1.15 ns

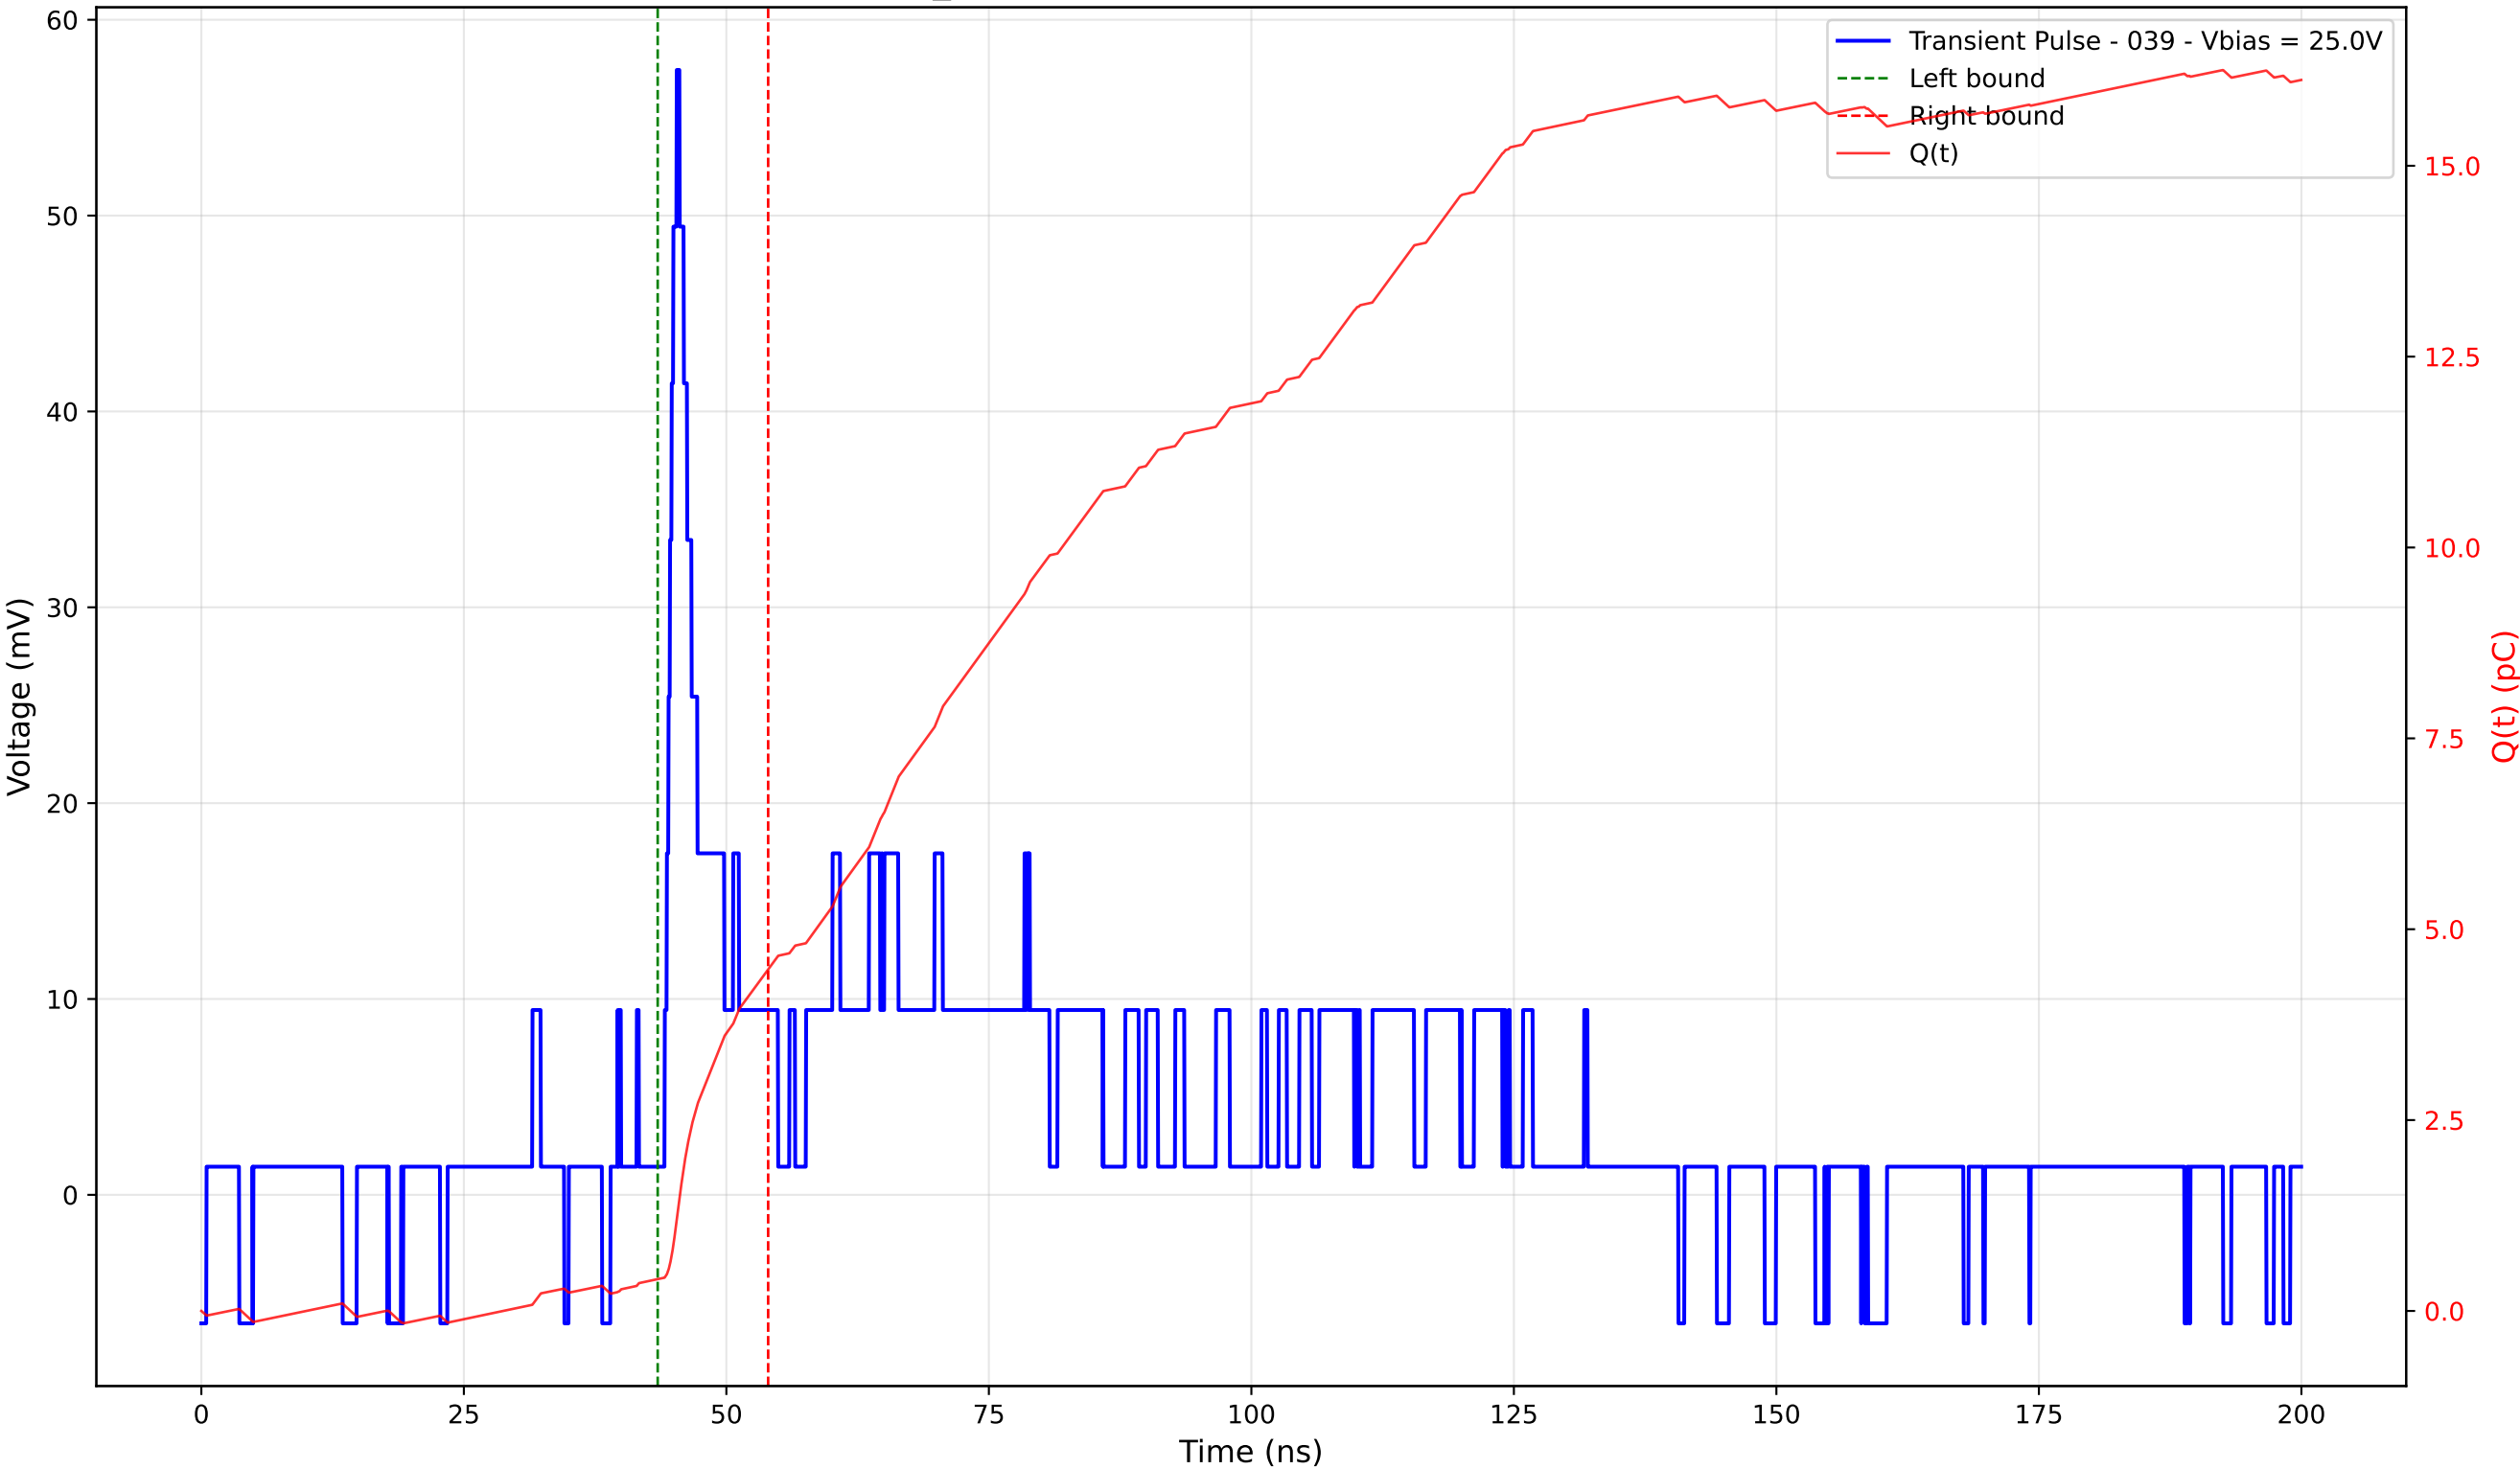


Transient Pulse - Sample: TD_4004 - Position: 60.0 μm - Charge: 15.05 pC - Rise Time: 0.88 ns

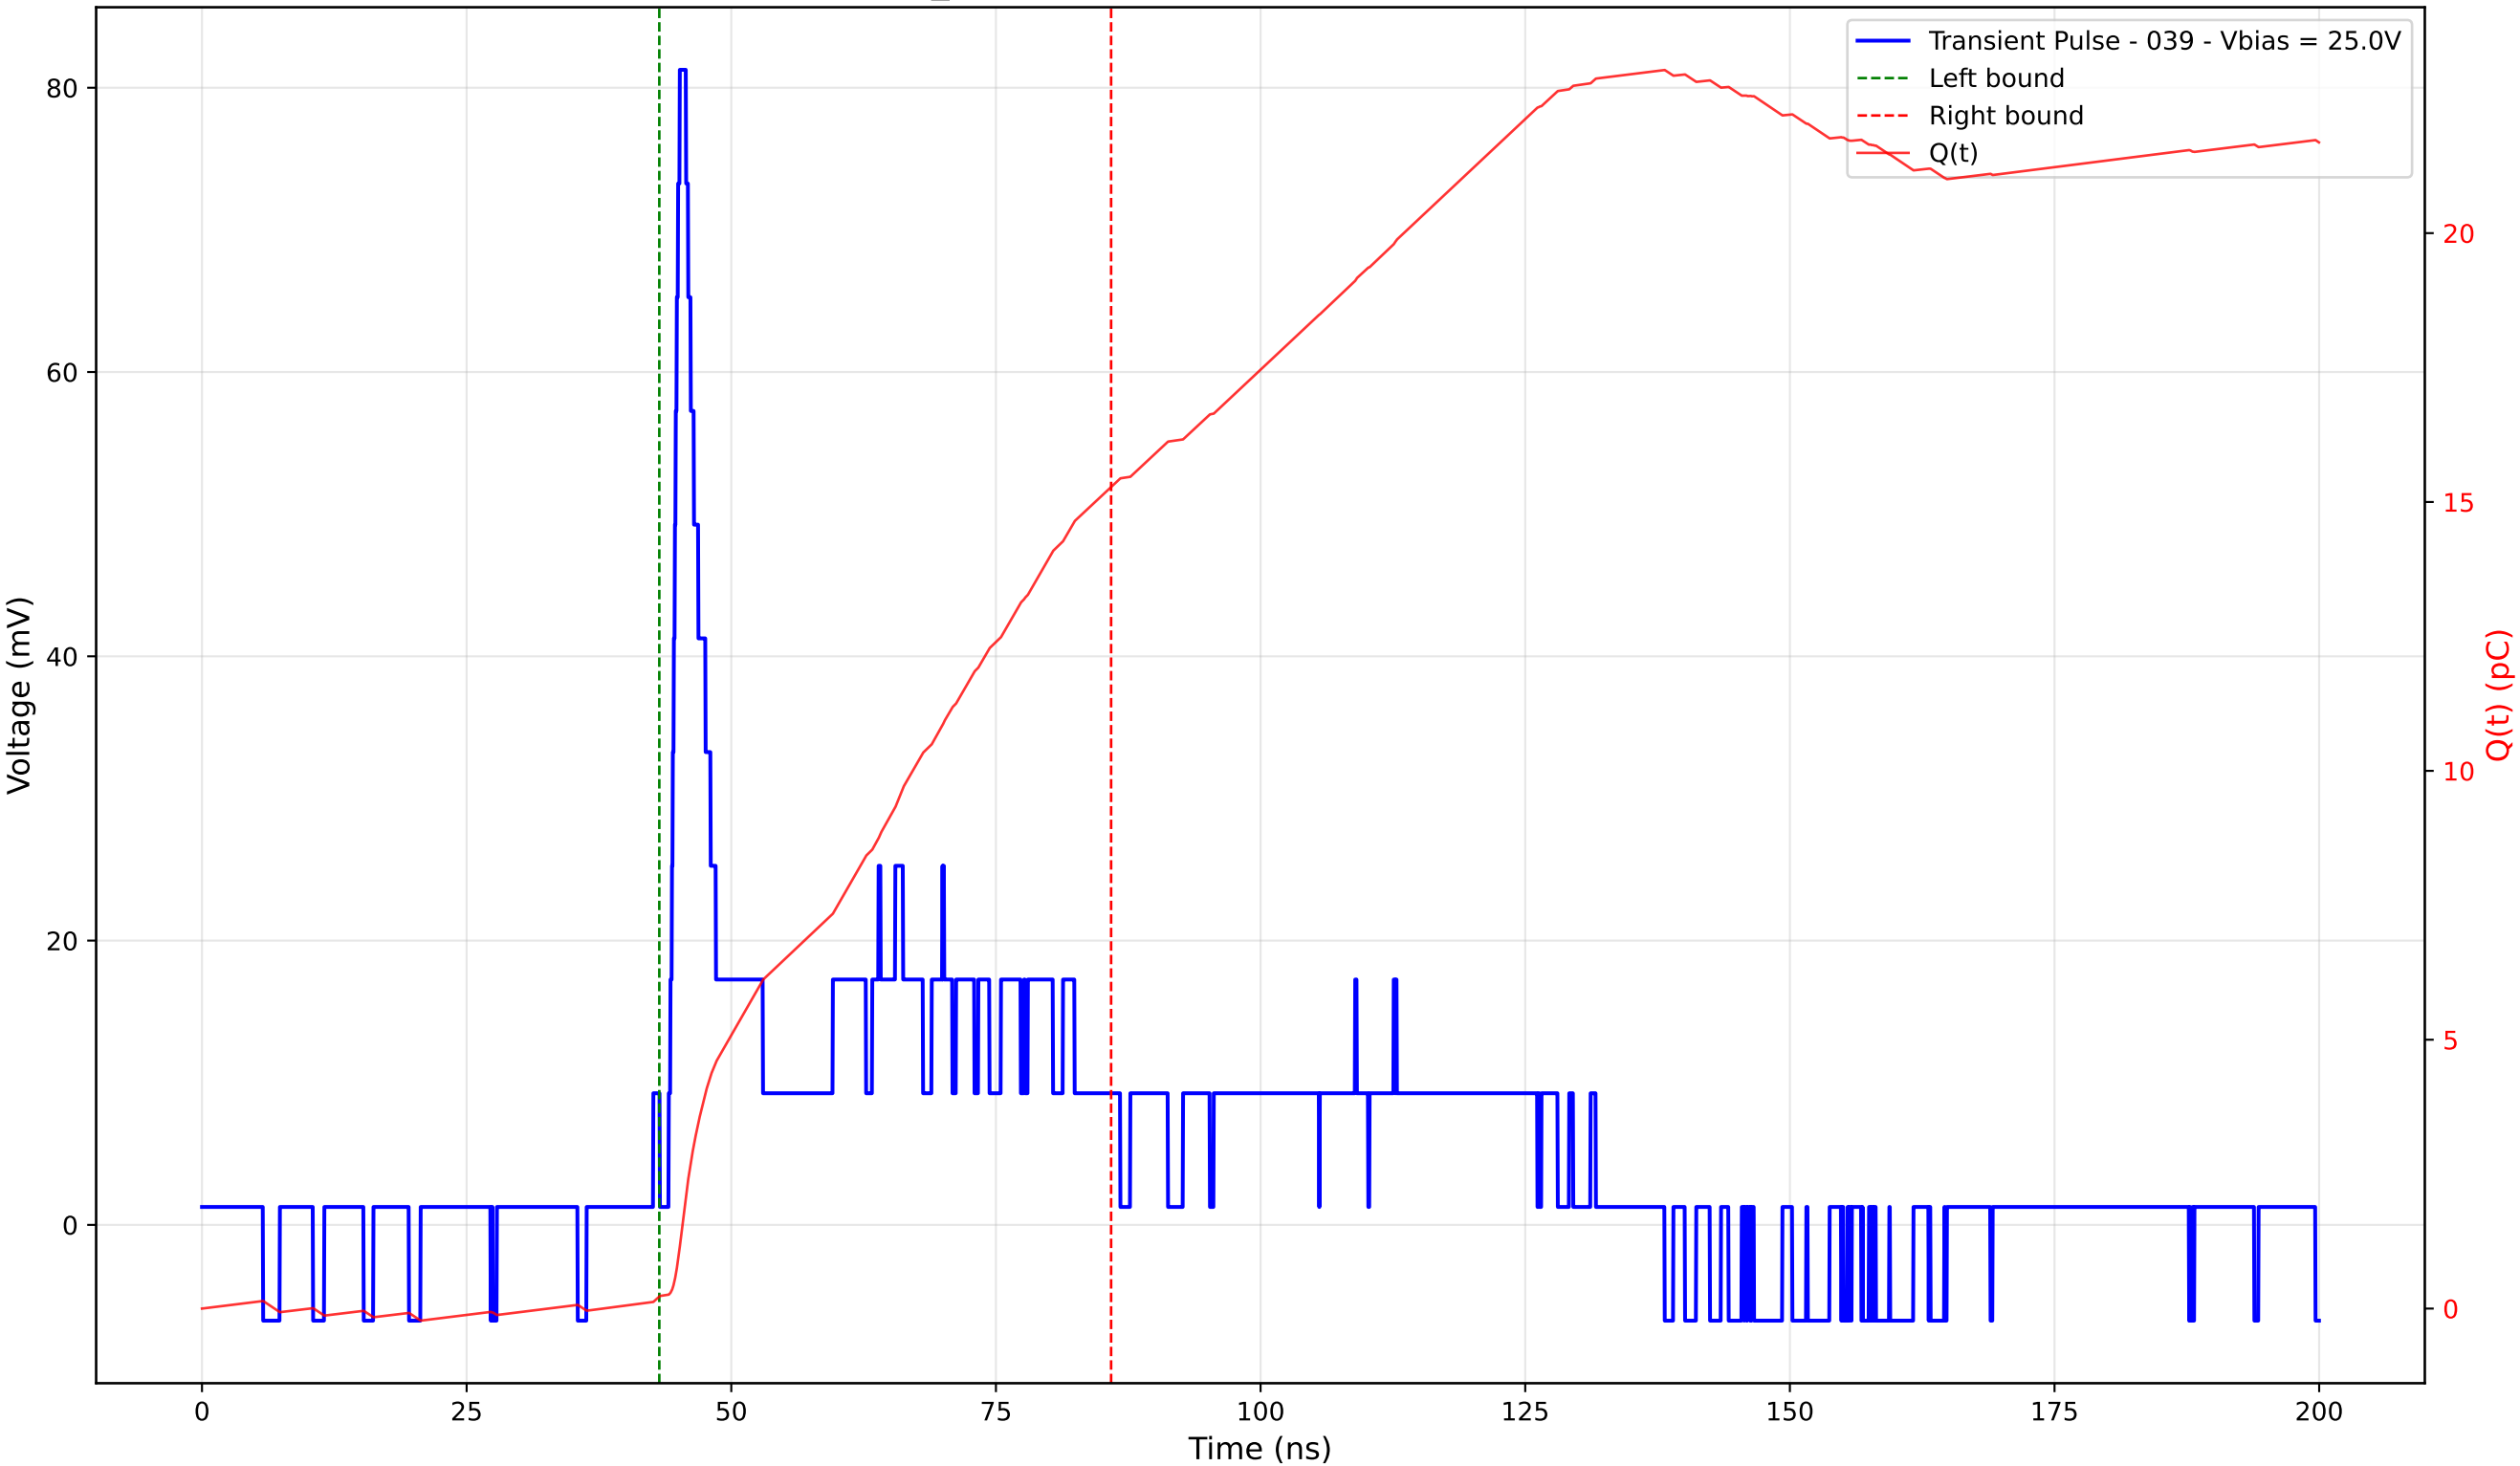


Transient Pulse - Sample: TD_4004 - Position: 65.0 μm - Charge: 42.44 pC - Rise Time: 0.92 ns

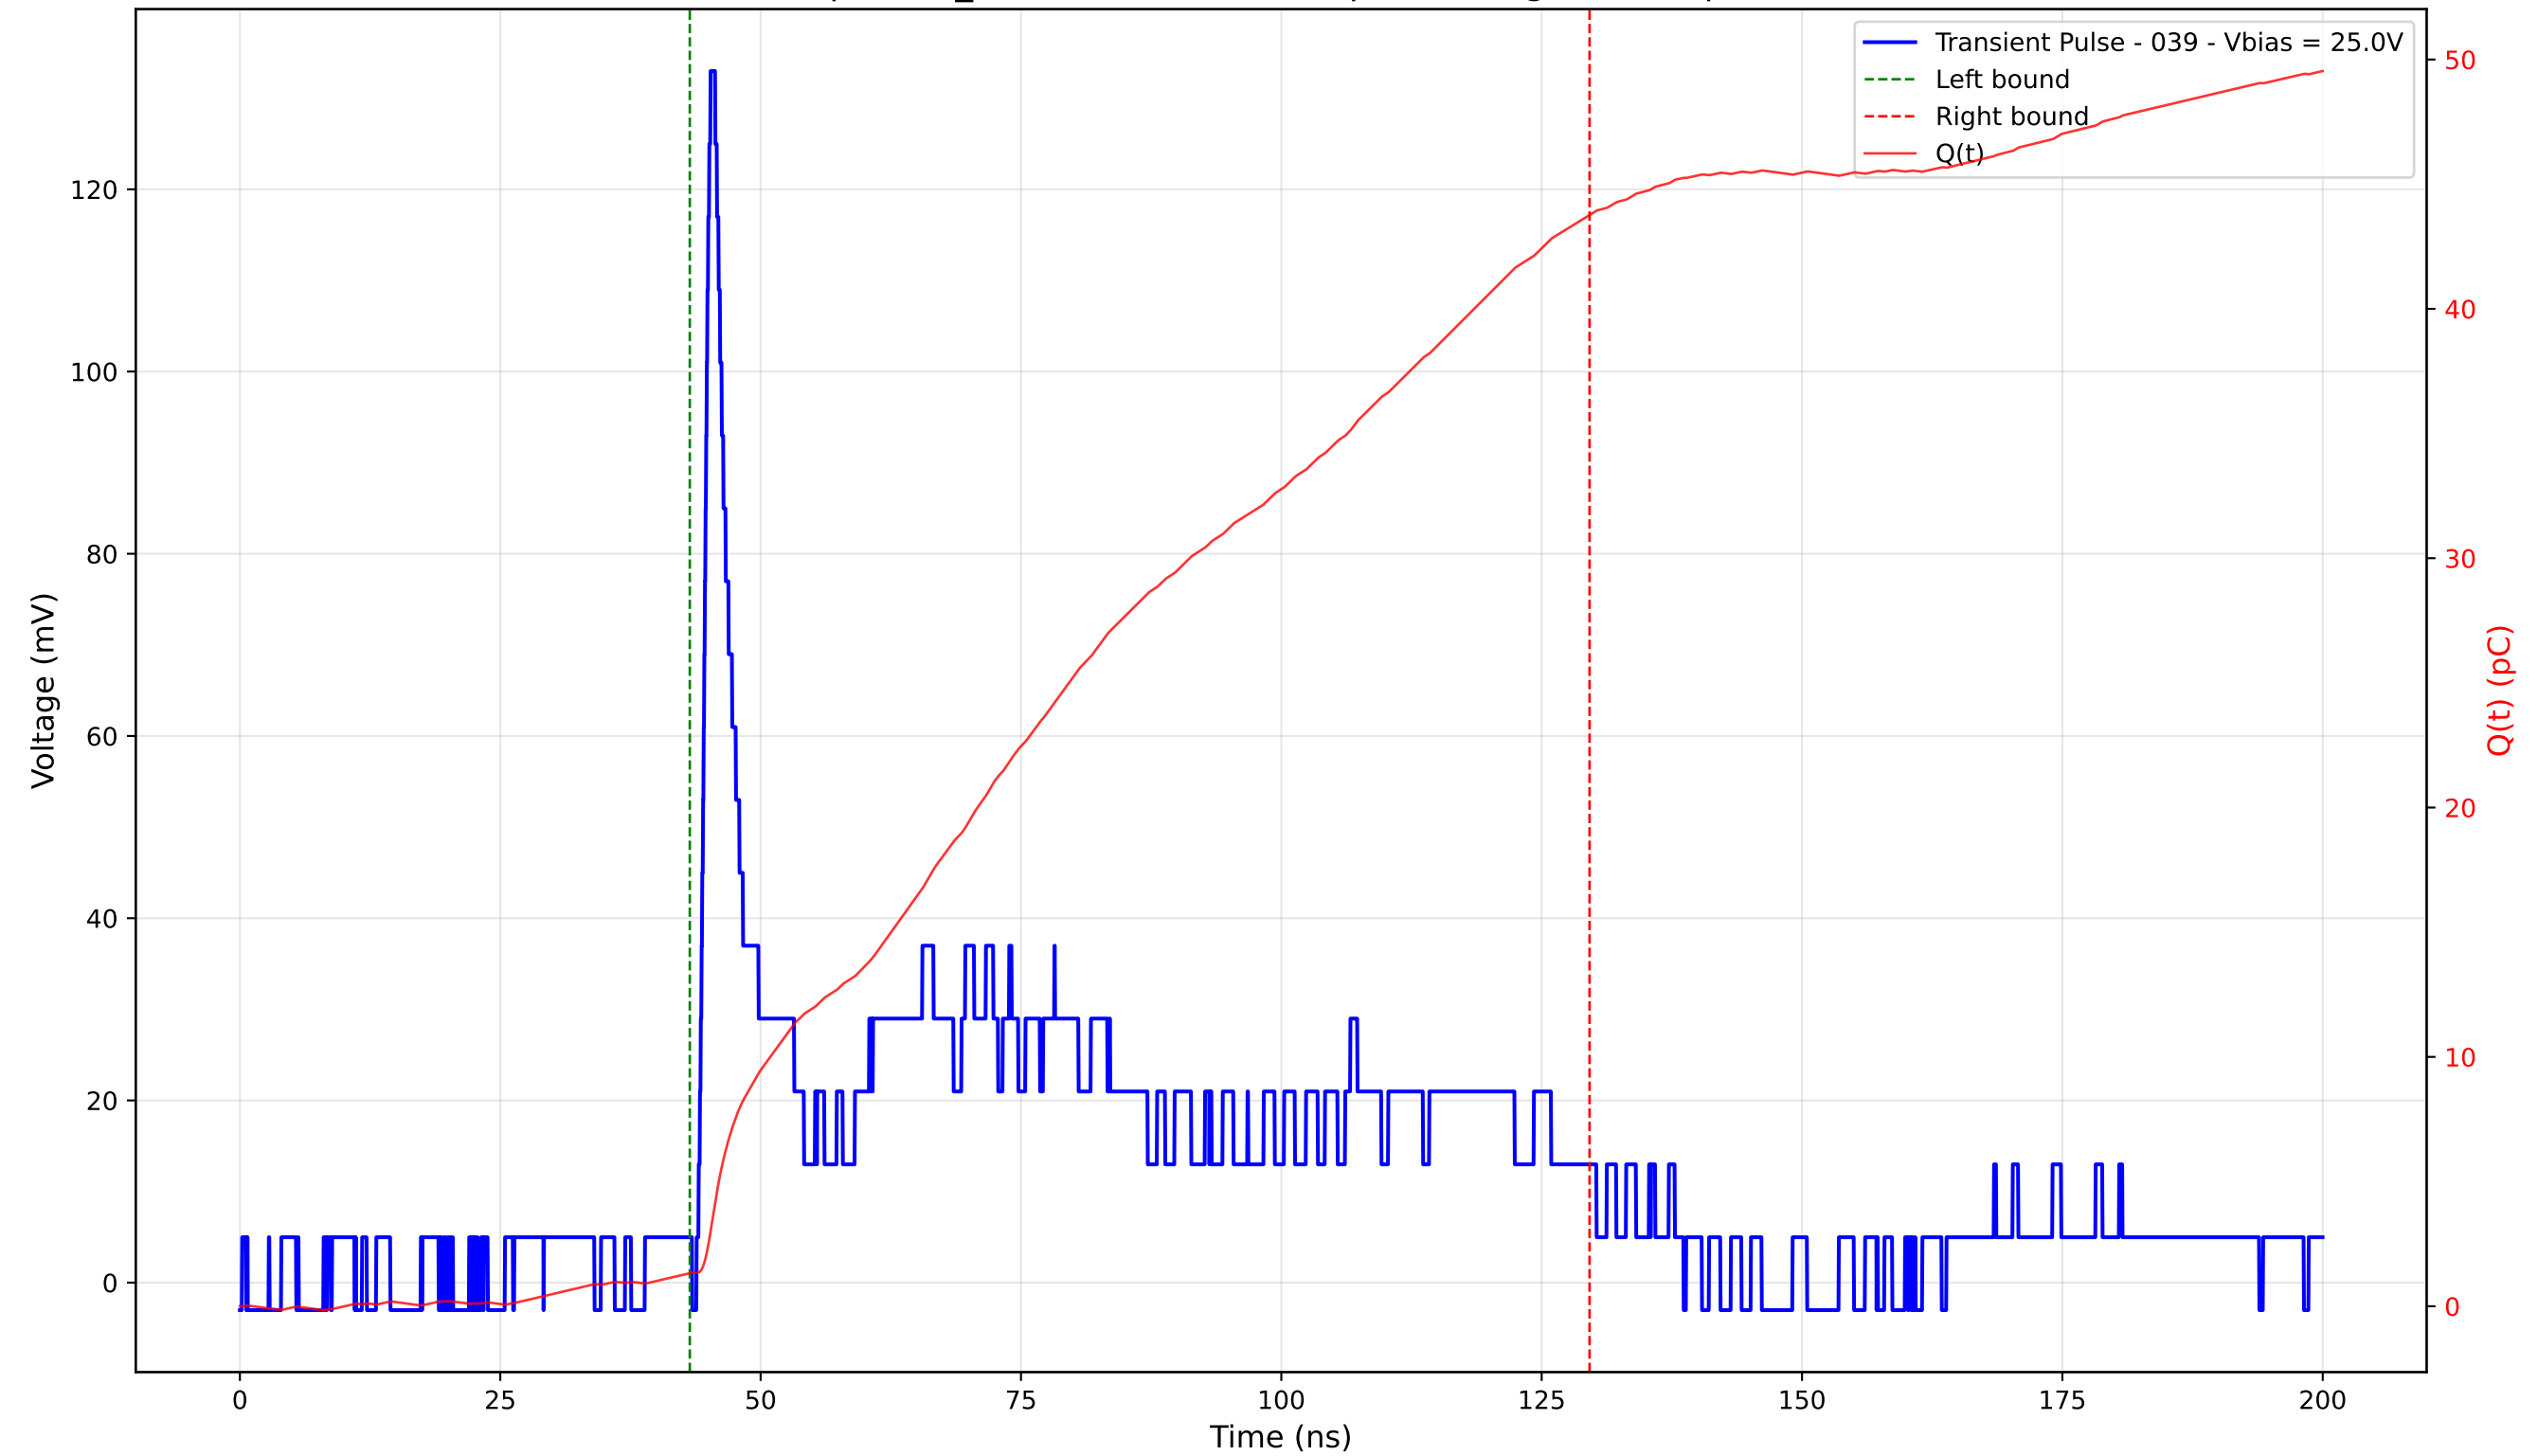


Transient Pulse - Sample: TD_4004 - Position: 70.0 μm - Charge: 62.54 pC - Rise Time: 0.92 ns

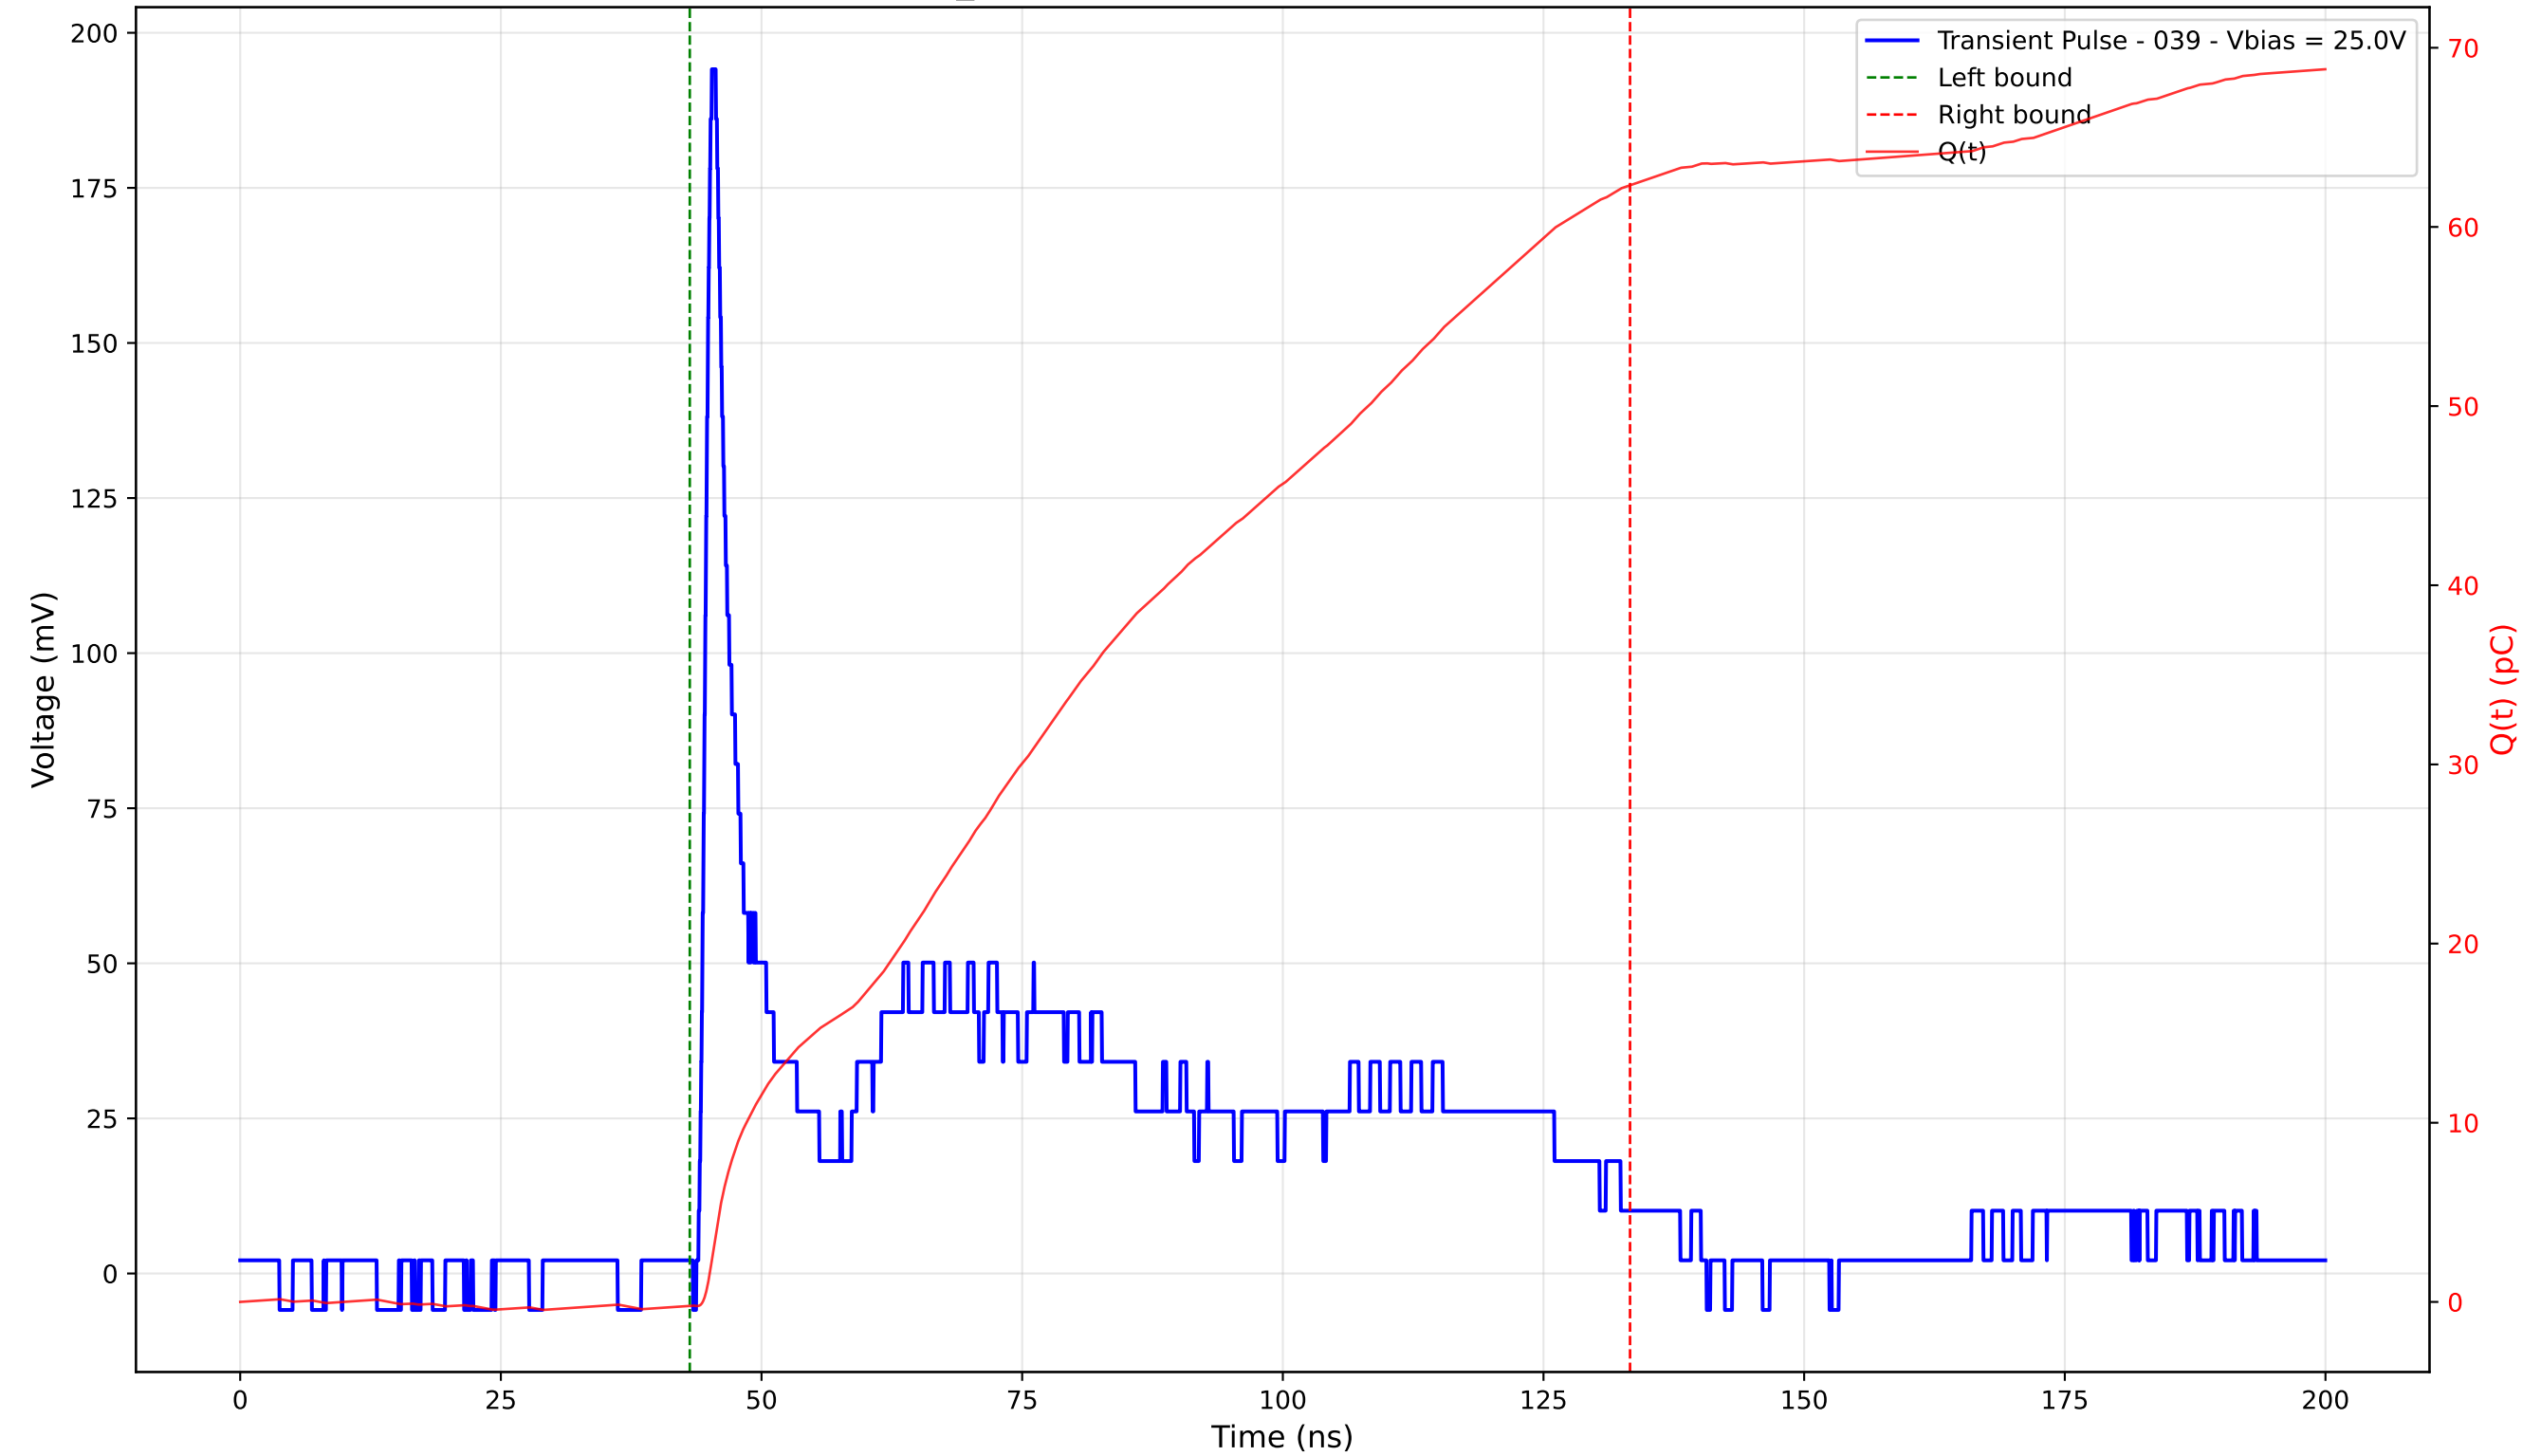


Transient Pulse - Sample: TD_4004 - Position: 75.0 μm - Charge: 85.22 pC - Rise Time: 0.98 ns

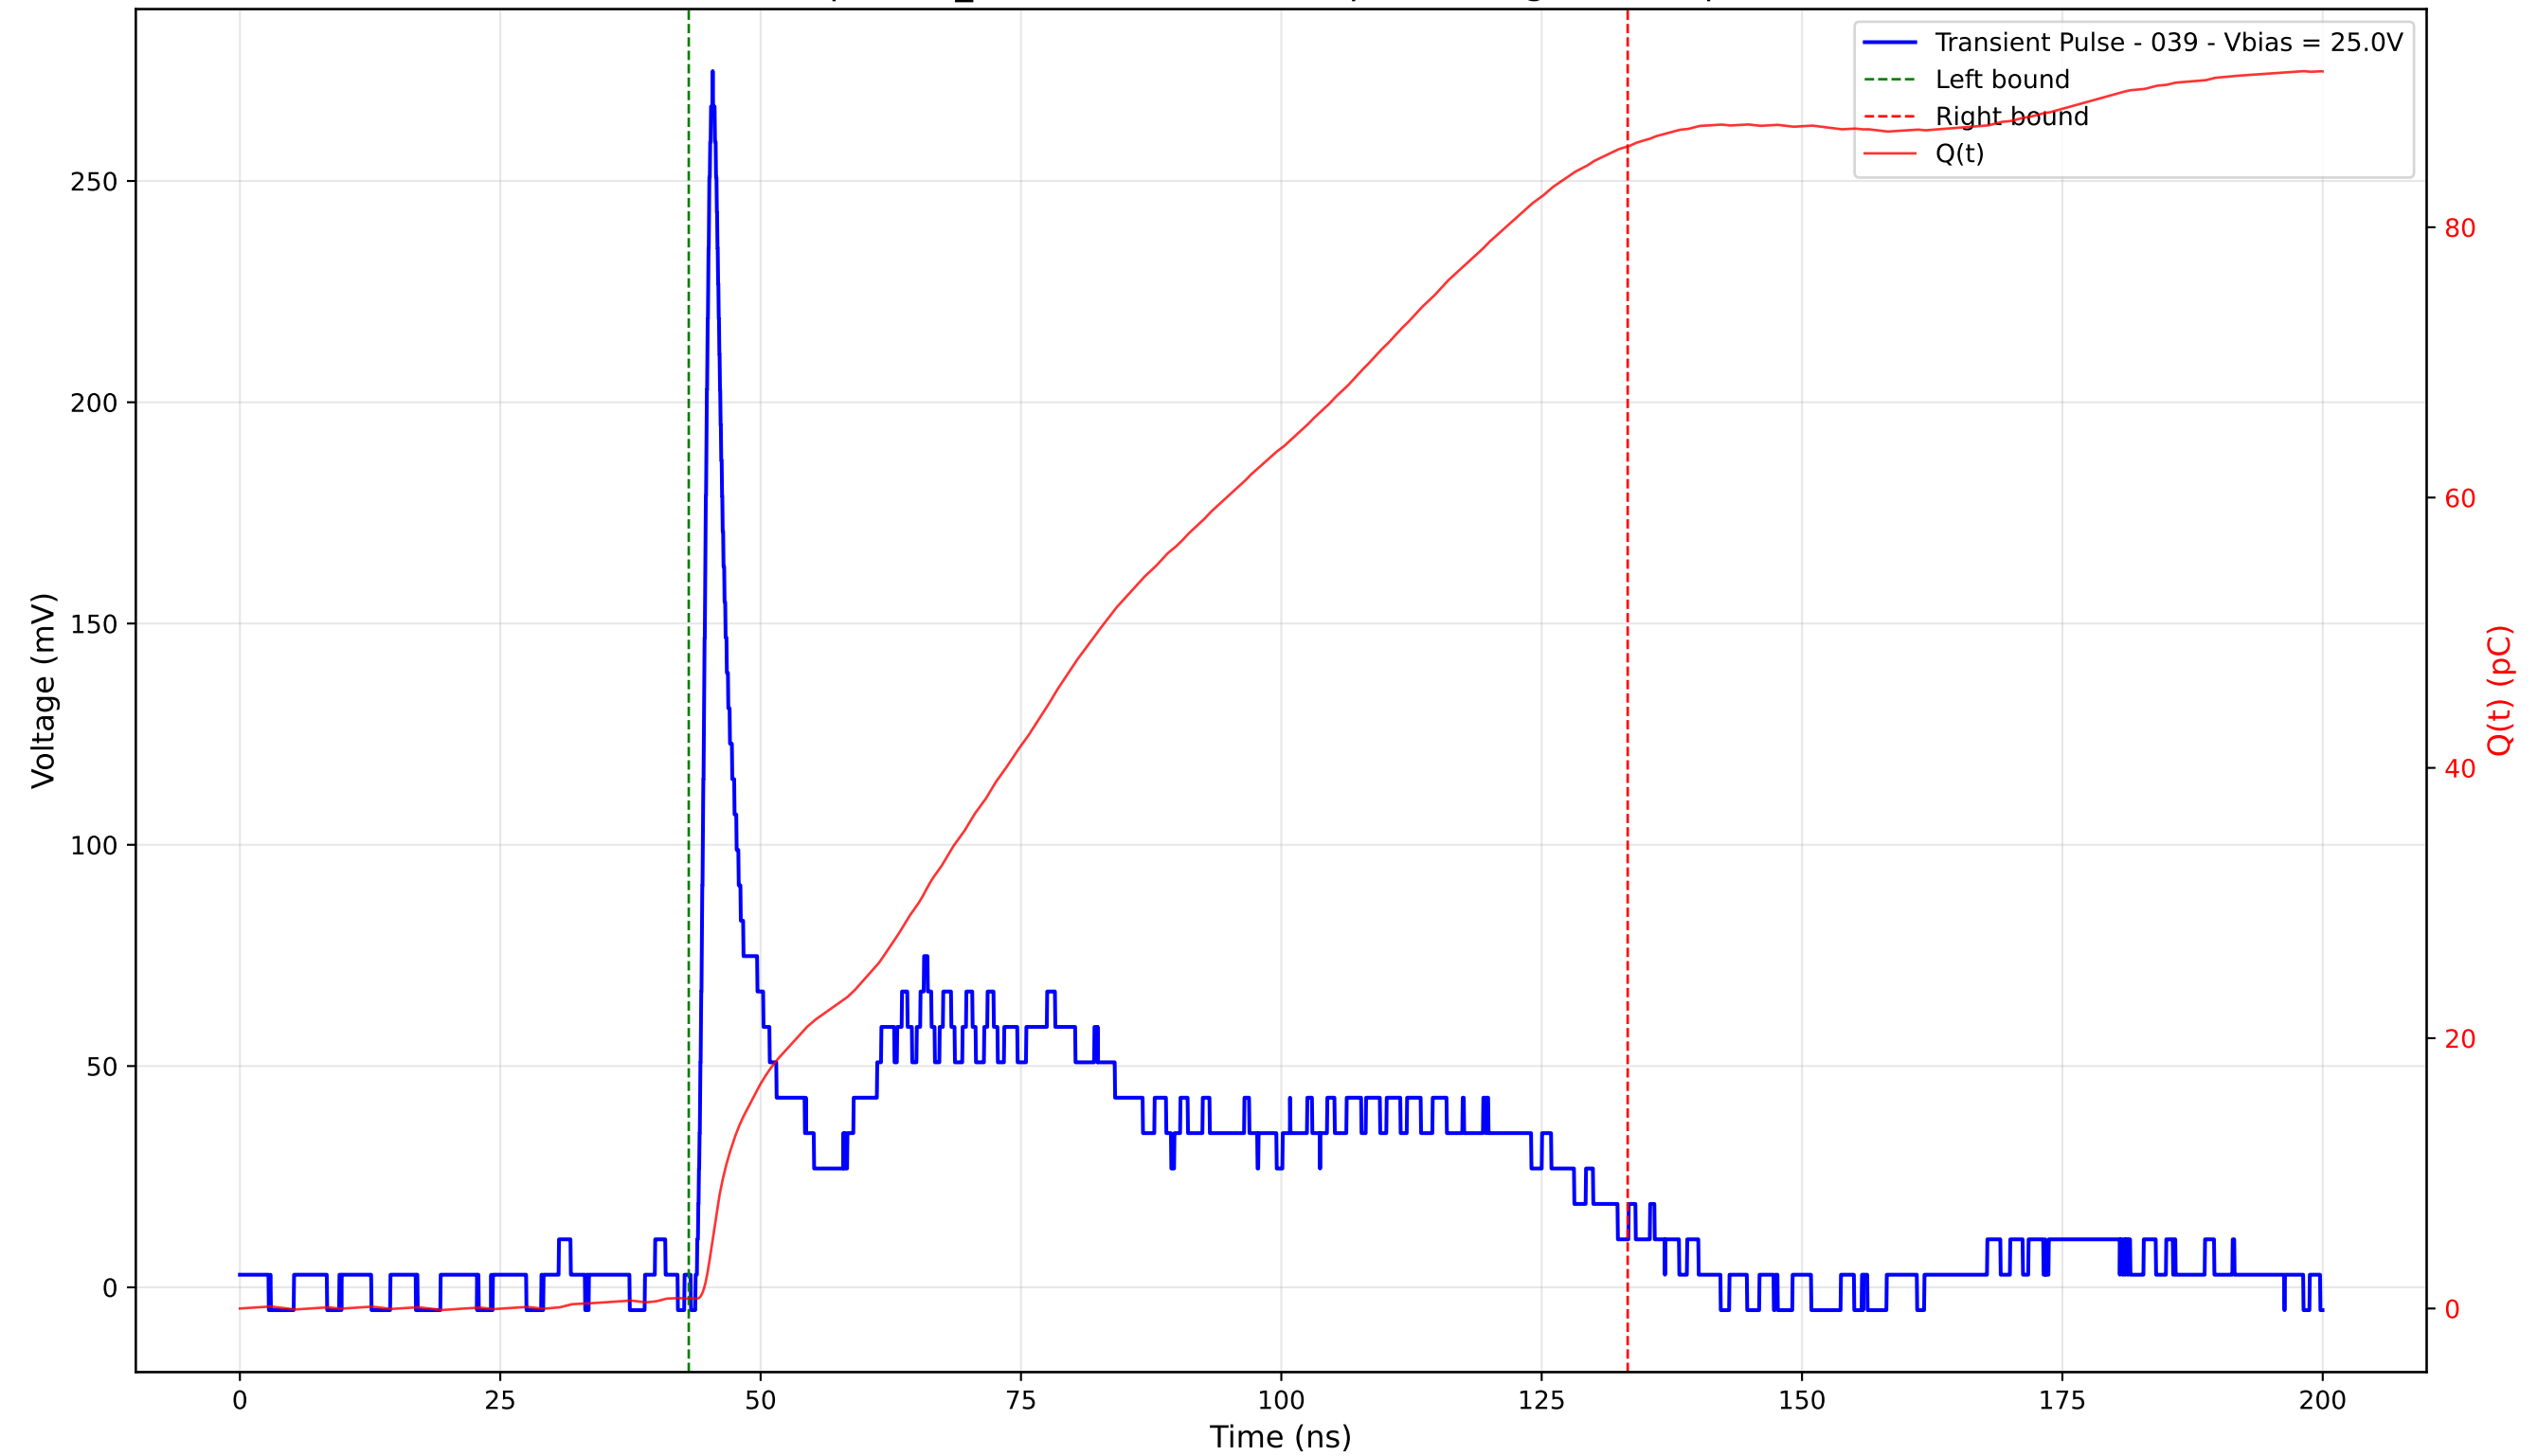


Transient Pulse - Sample: TD_4004 - Position: 80.0 μm - Charge: 99.27 pC - Rise Time: 0.94 ns

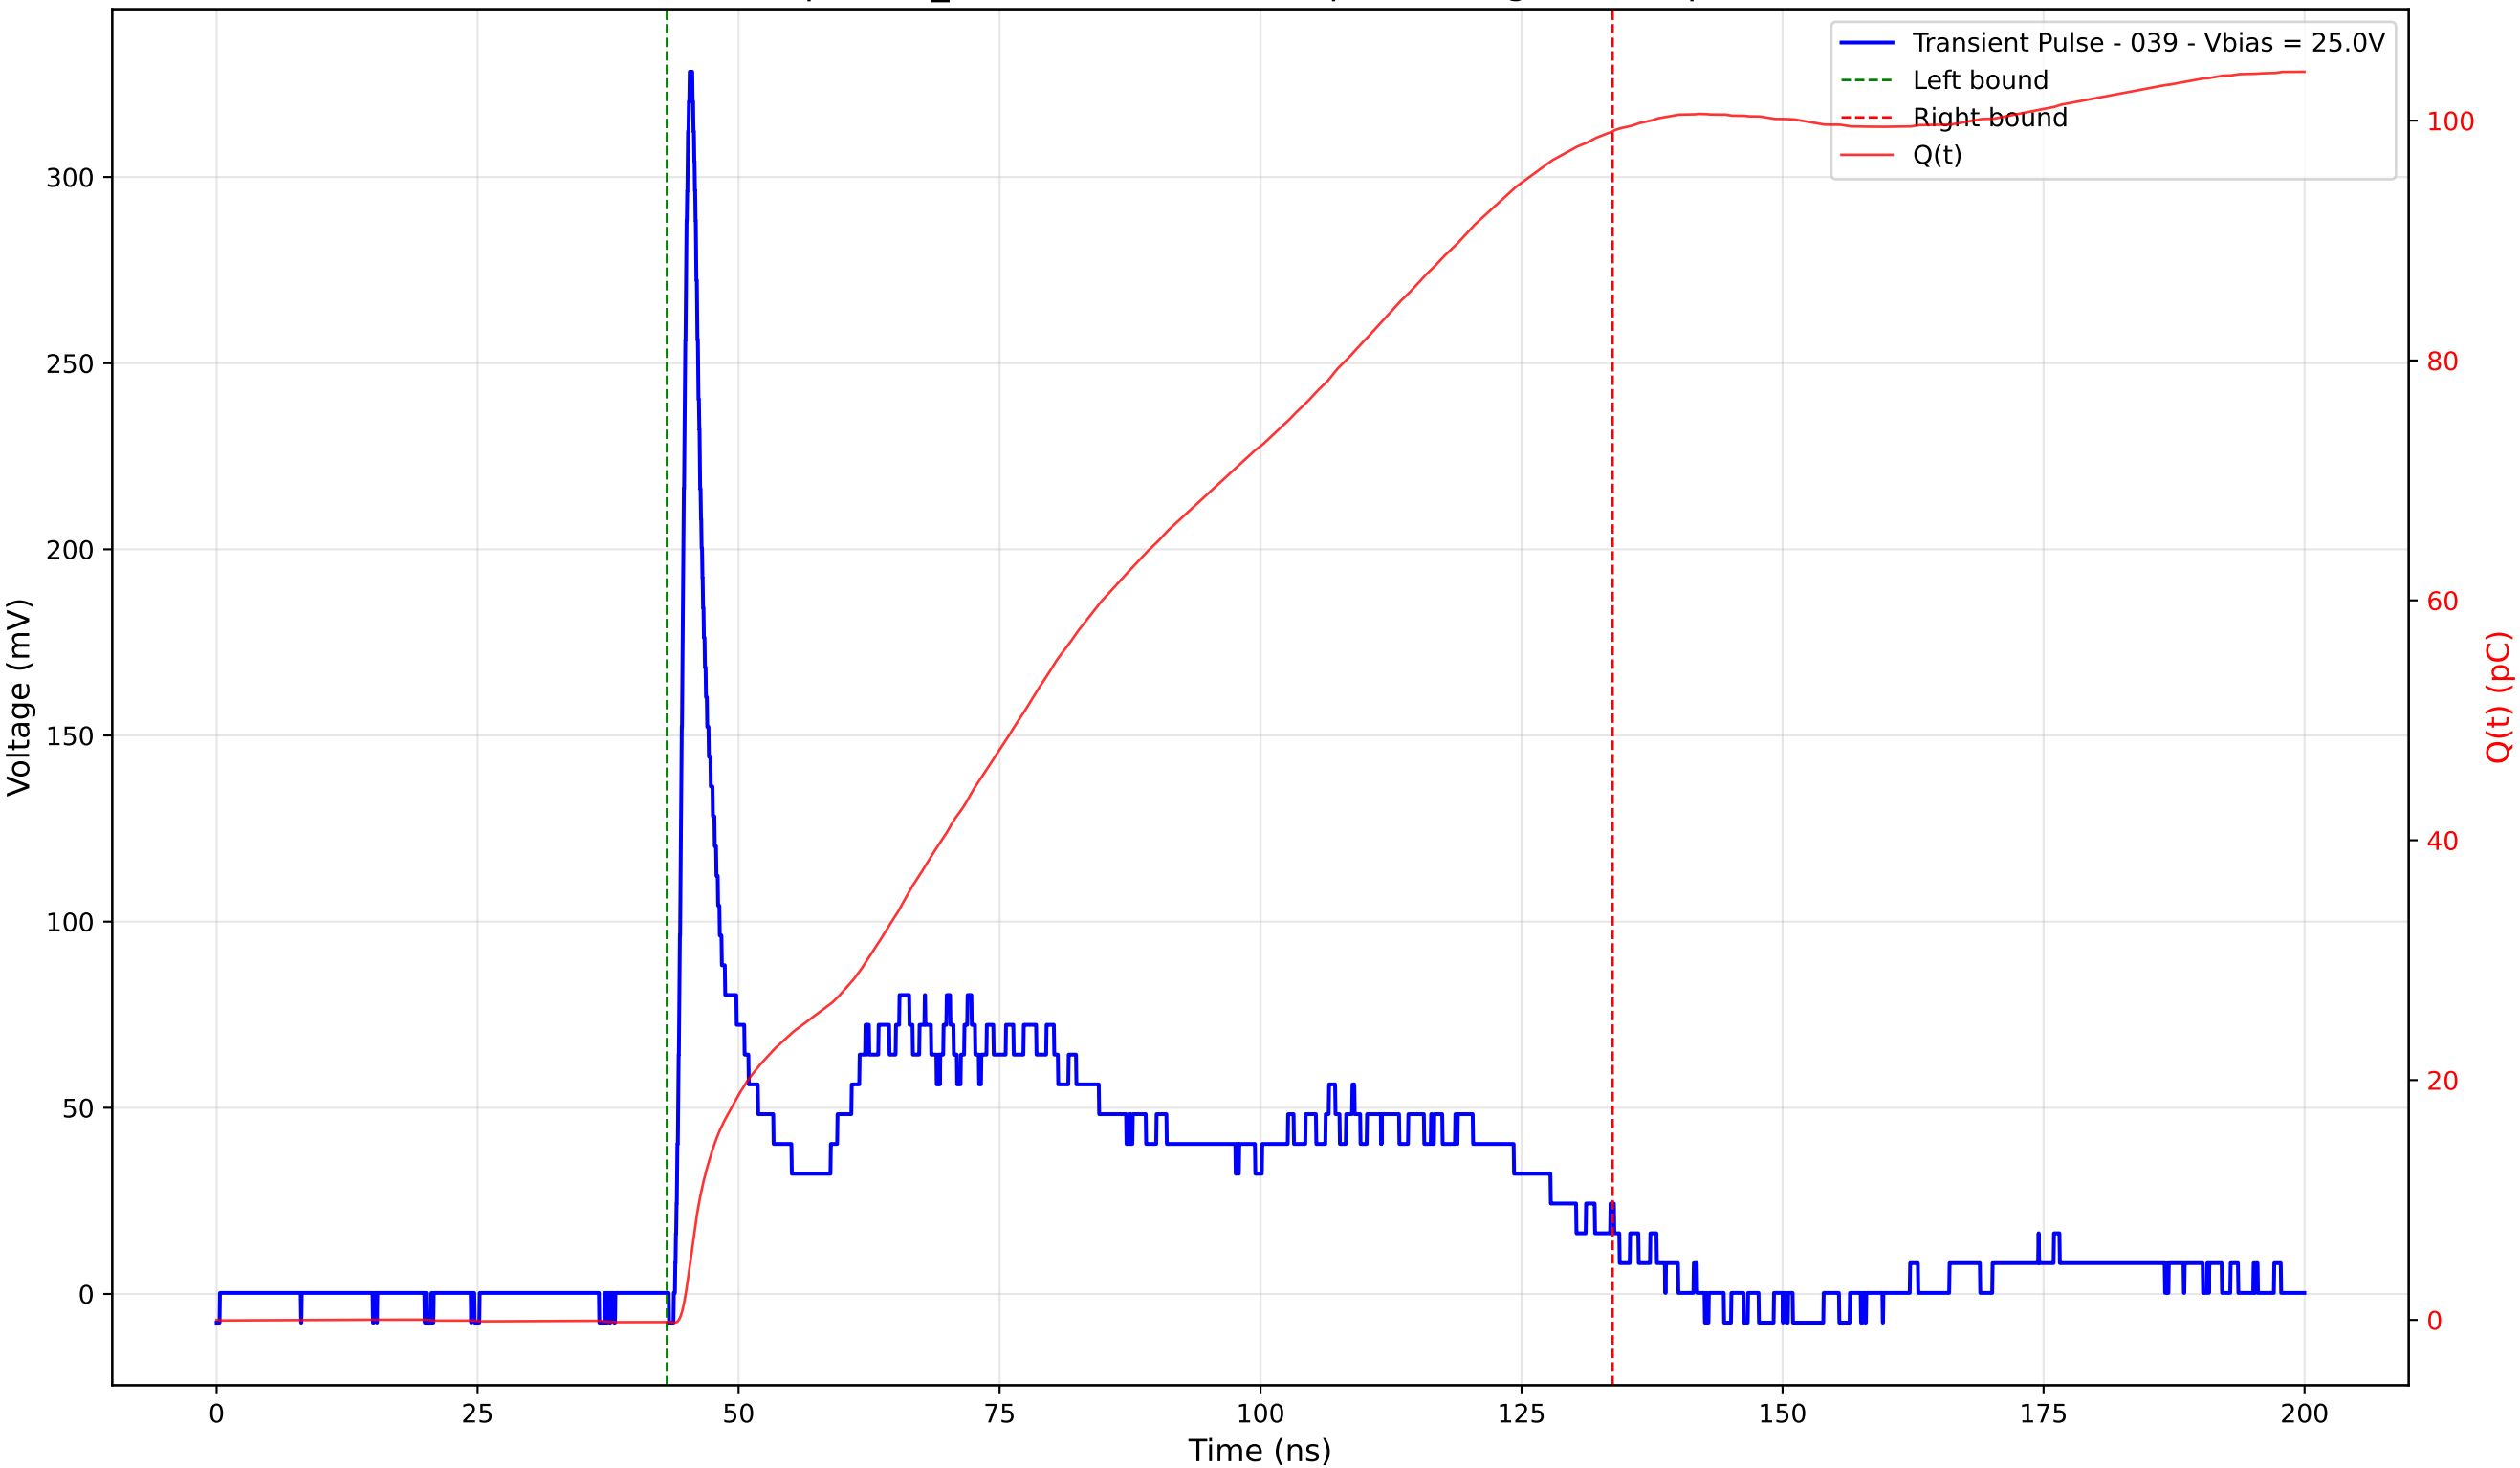


Transient Pulse - Sample: TD_4004 - Position: 85.0 μm - Charge: 113.52 pC - Rise Time: 0.97 ns

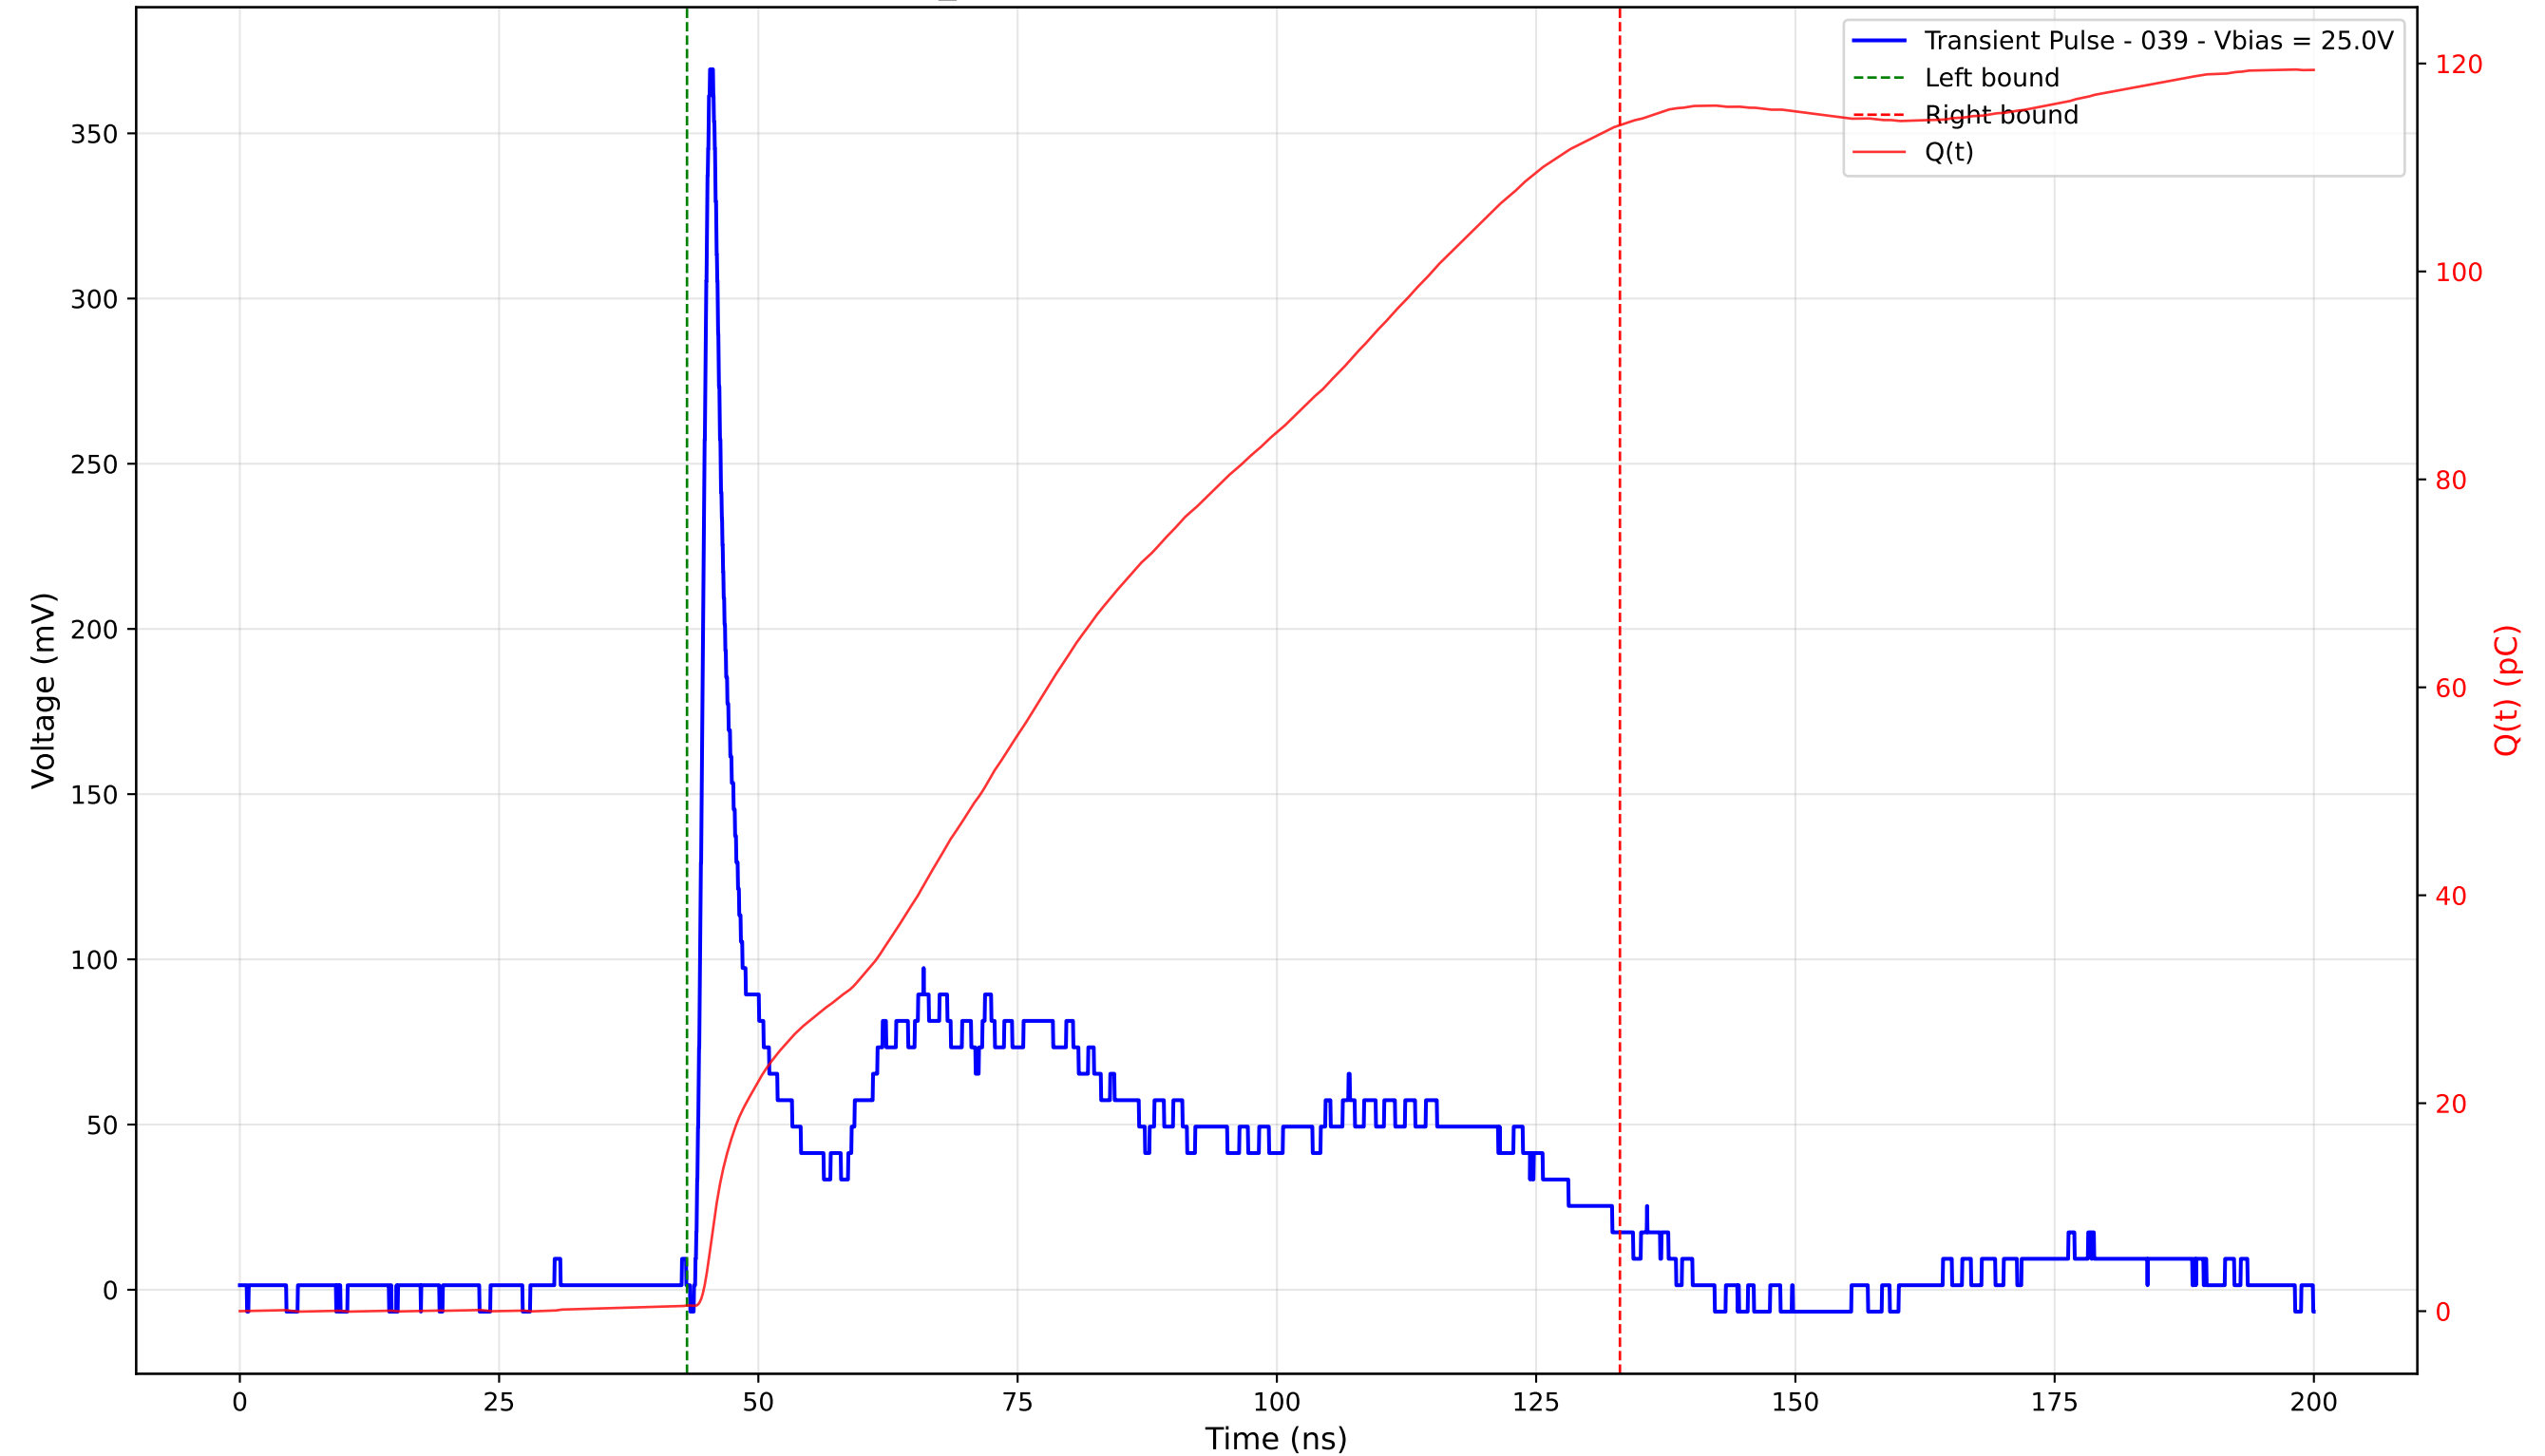


Transient Pulse - Sample: TD_4004 - Position: 90.0 μm - Charge: 120.82 pC - Rise Time: 1.00 ns

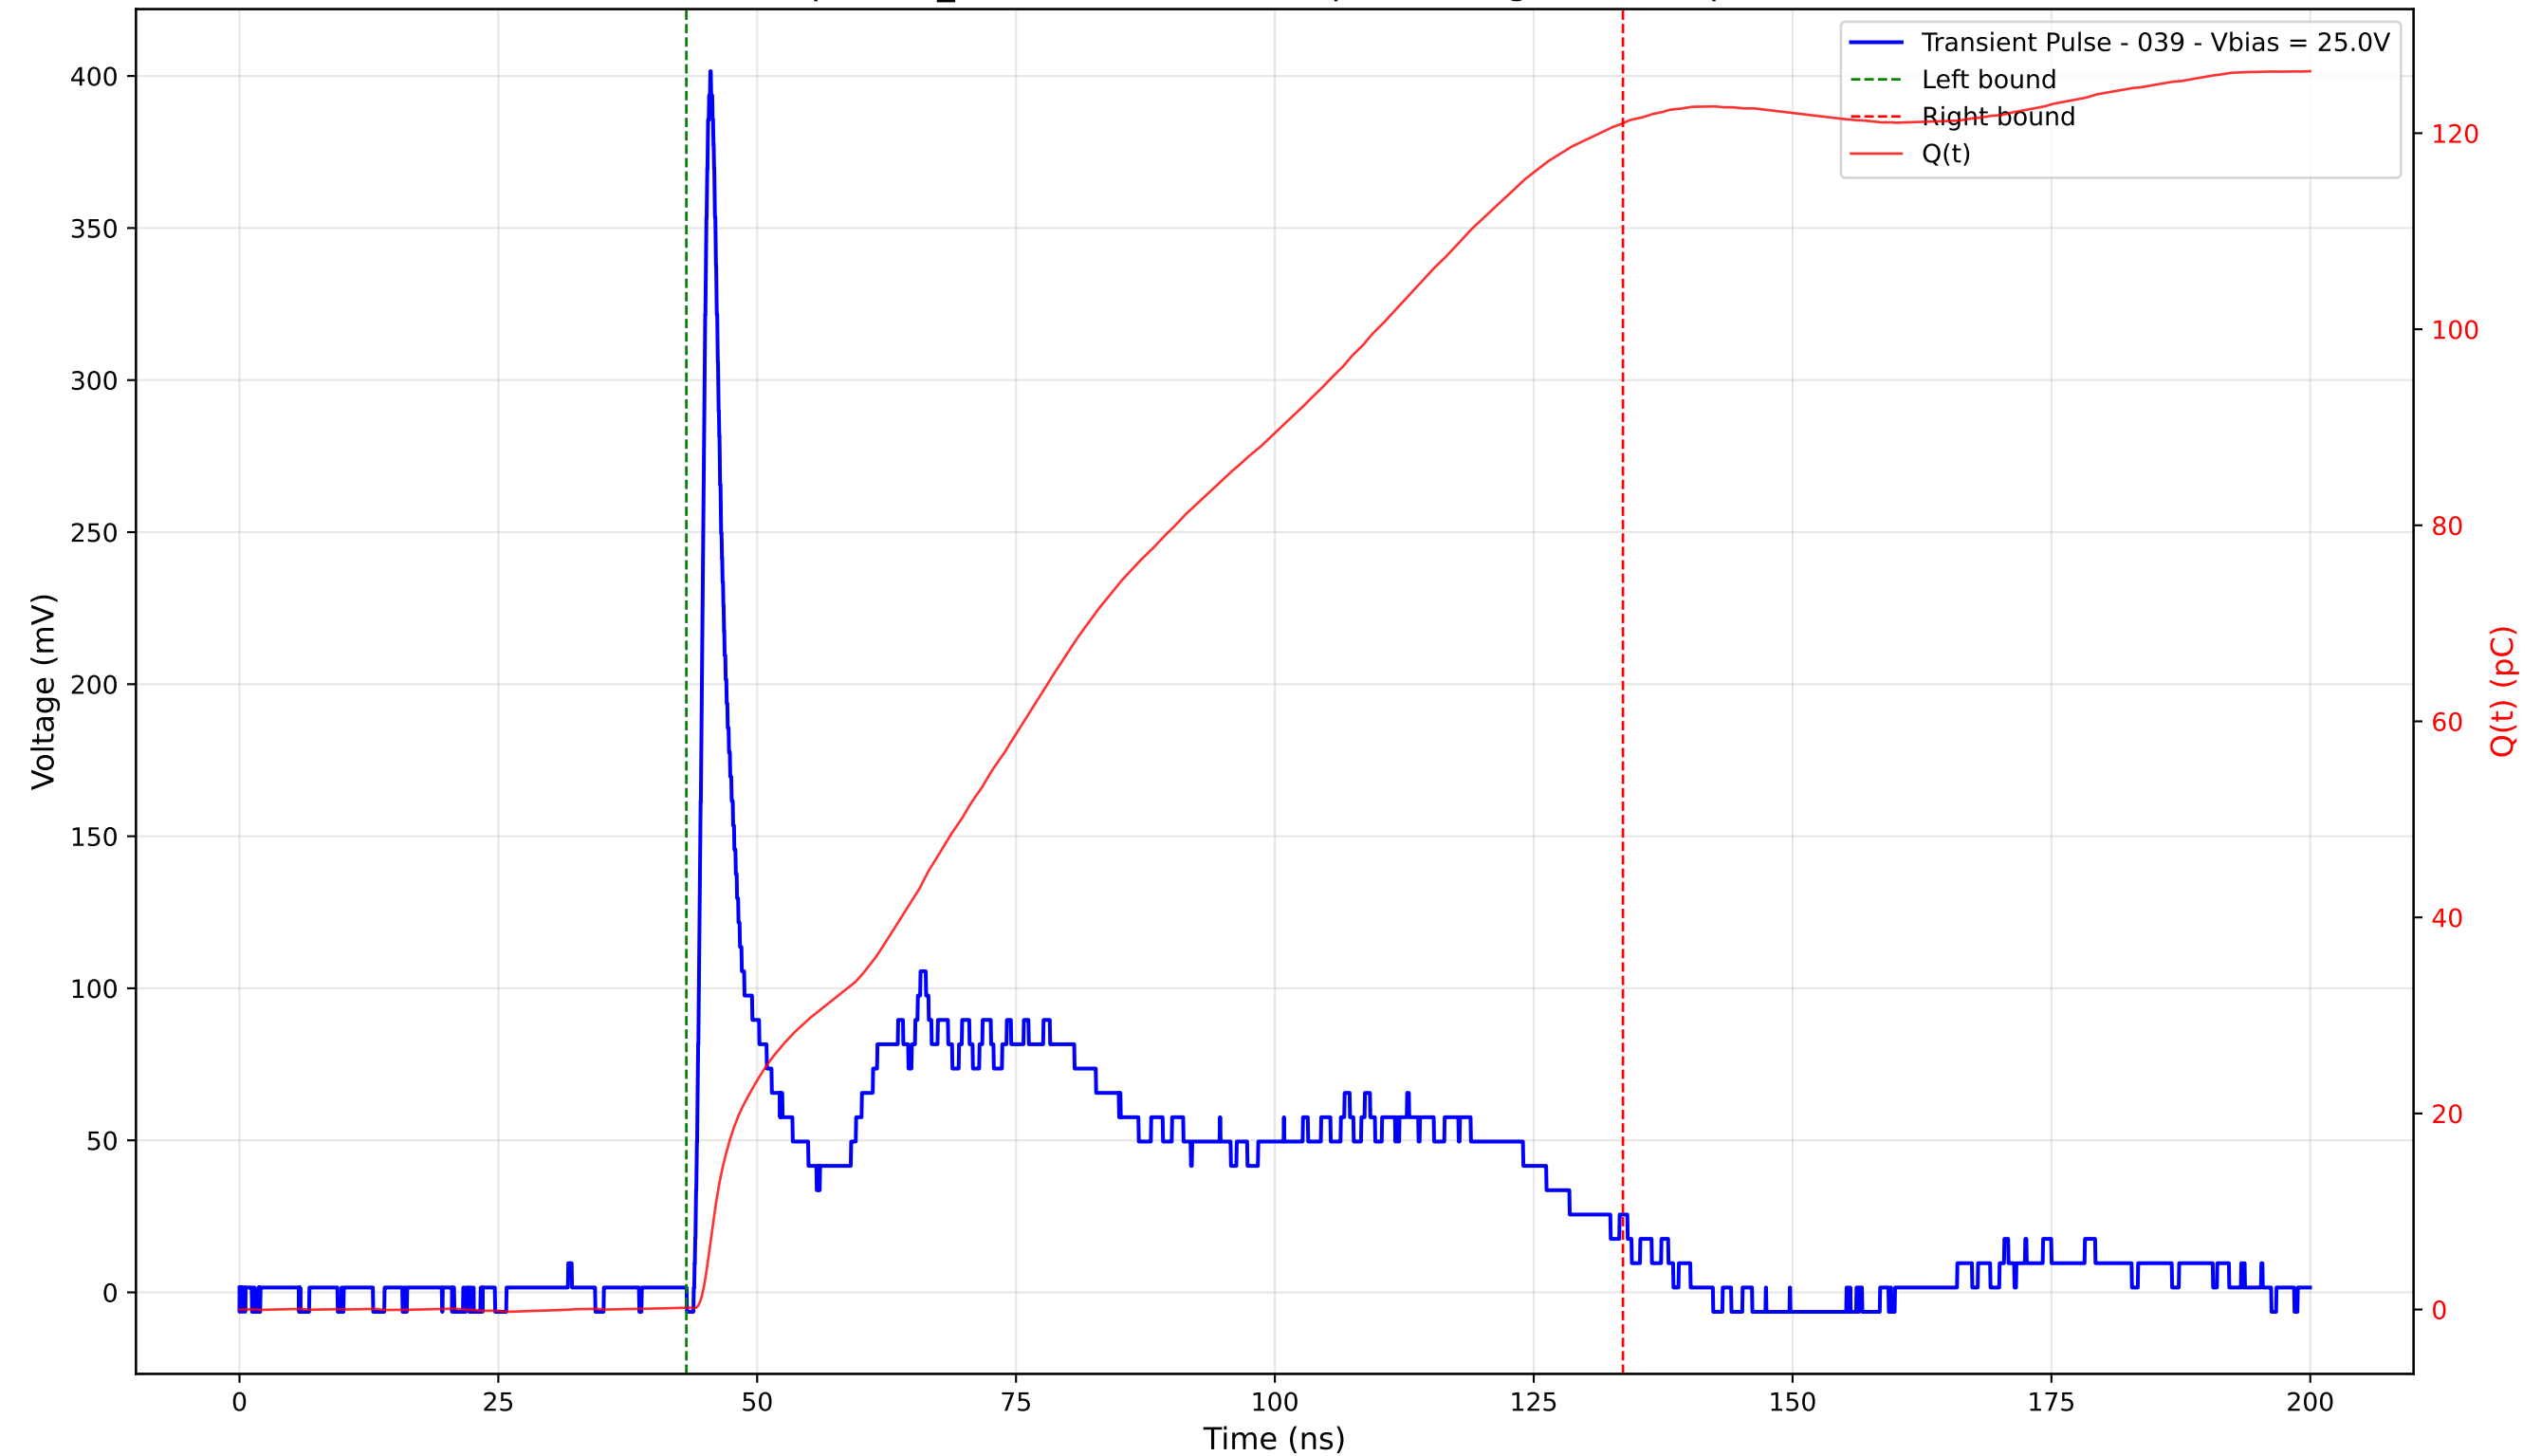


Transient Pulse - Sample: TD_4004 - Position: 95.0 μm - Charge: 130.31 pC - Rise Time: 1.02 ns

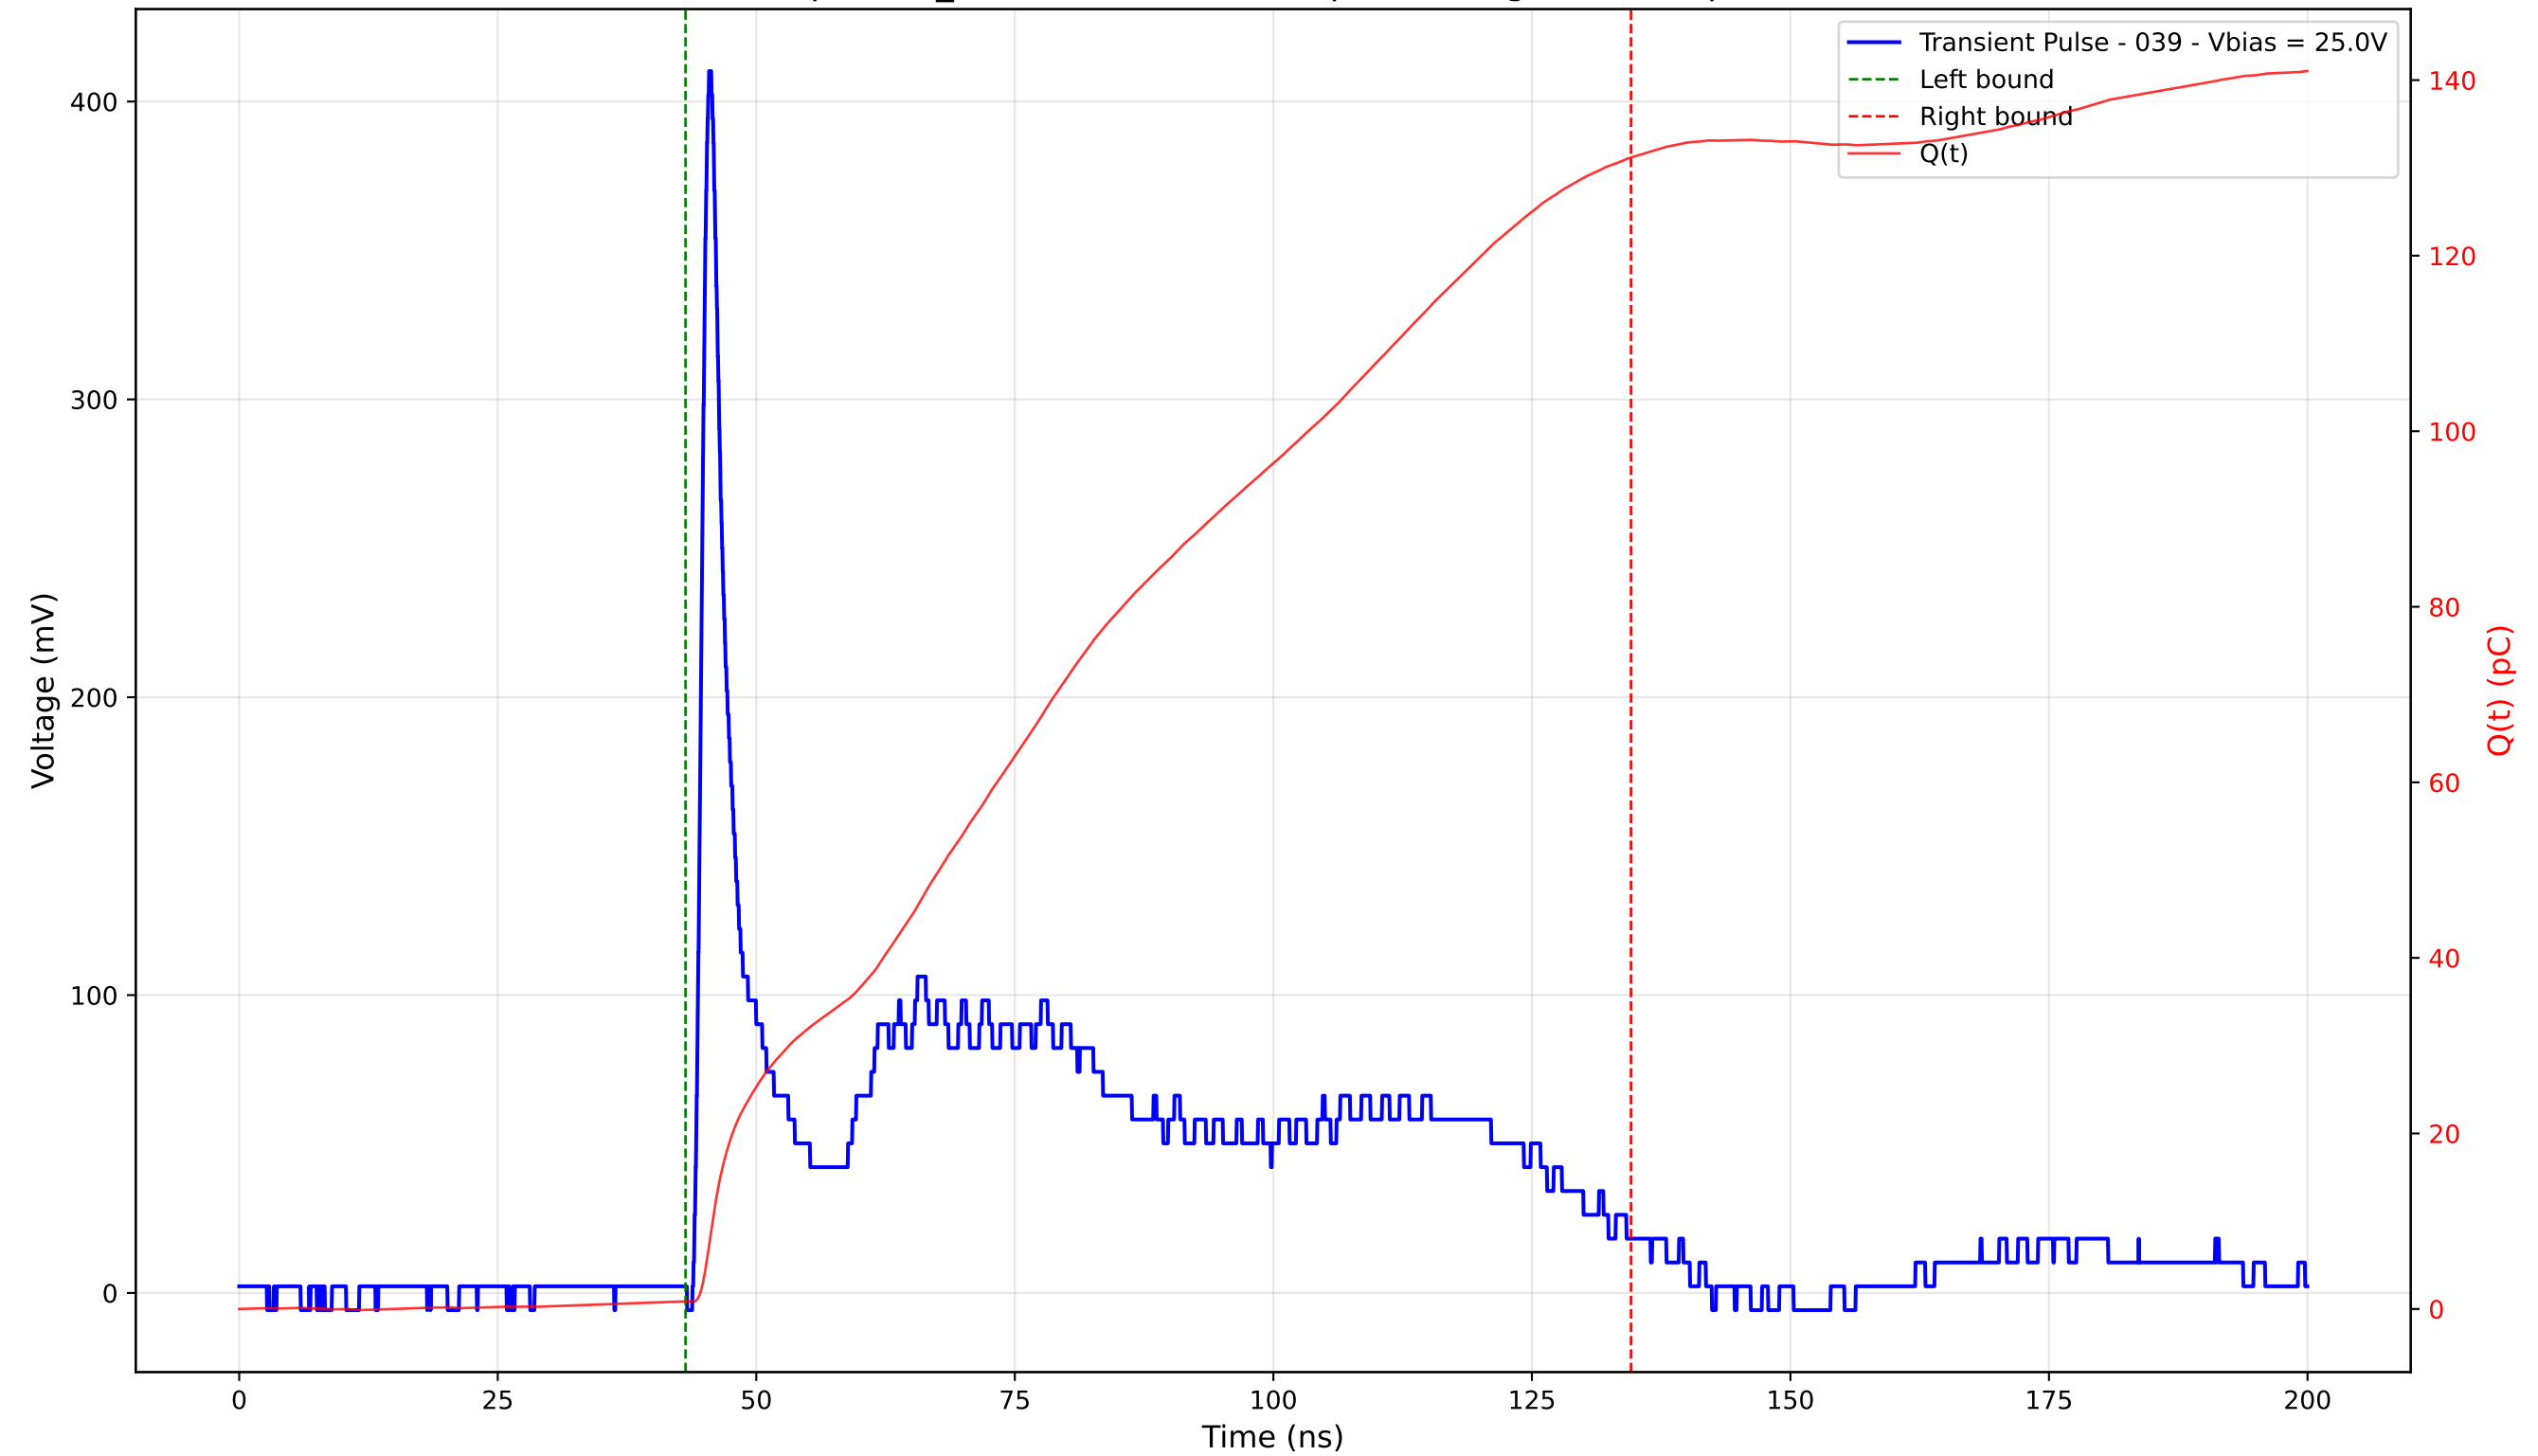


Transient Pulse - Sample: TD_4004 - Position: 100.0 μm - Charge: 142.15 pC - Rise Time: 1.04 ns

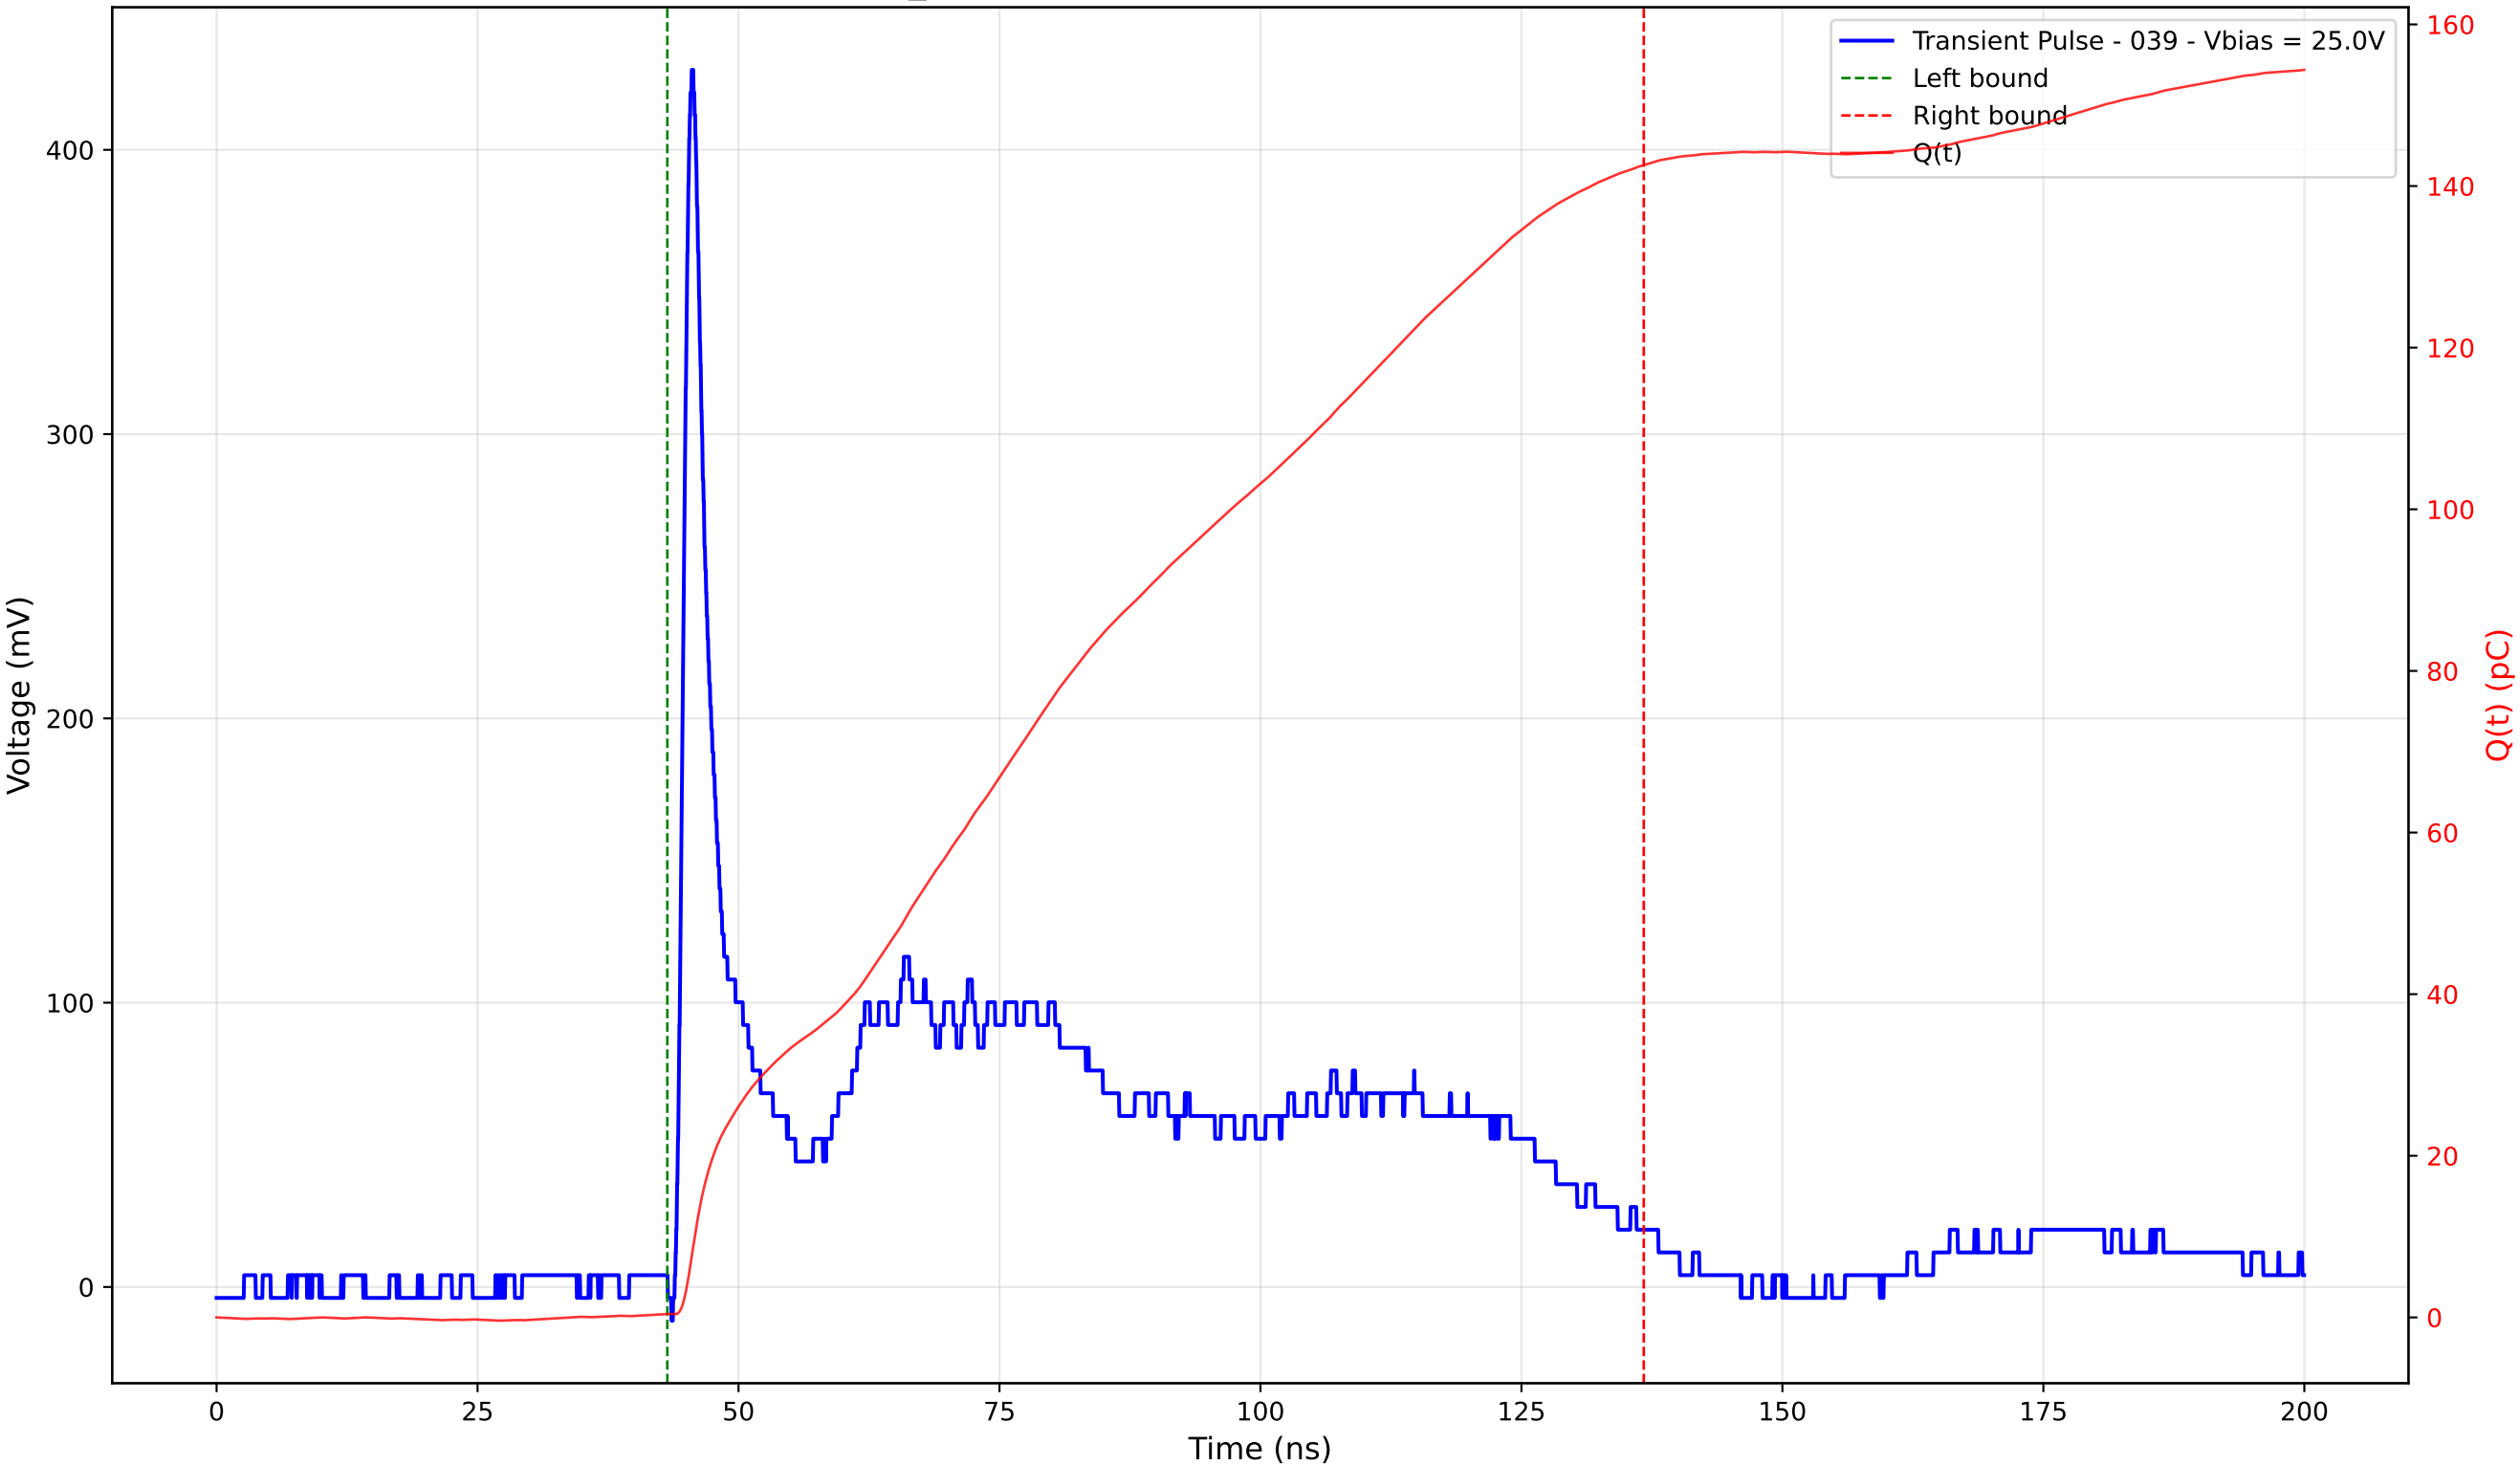


Transient Pulse - Sample: TD_4004 - Position: 105.0 μm - Charge: 146.93 pC - Rise Time: 1.07 ns

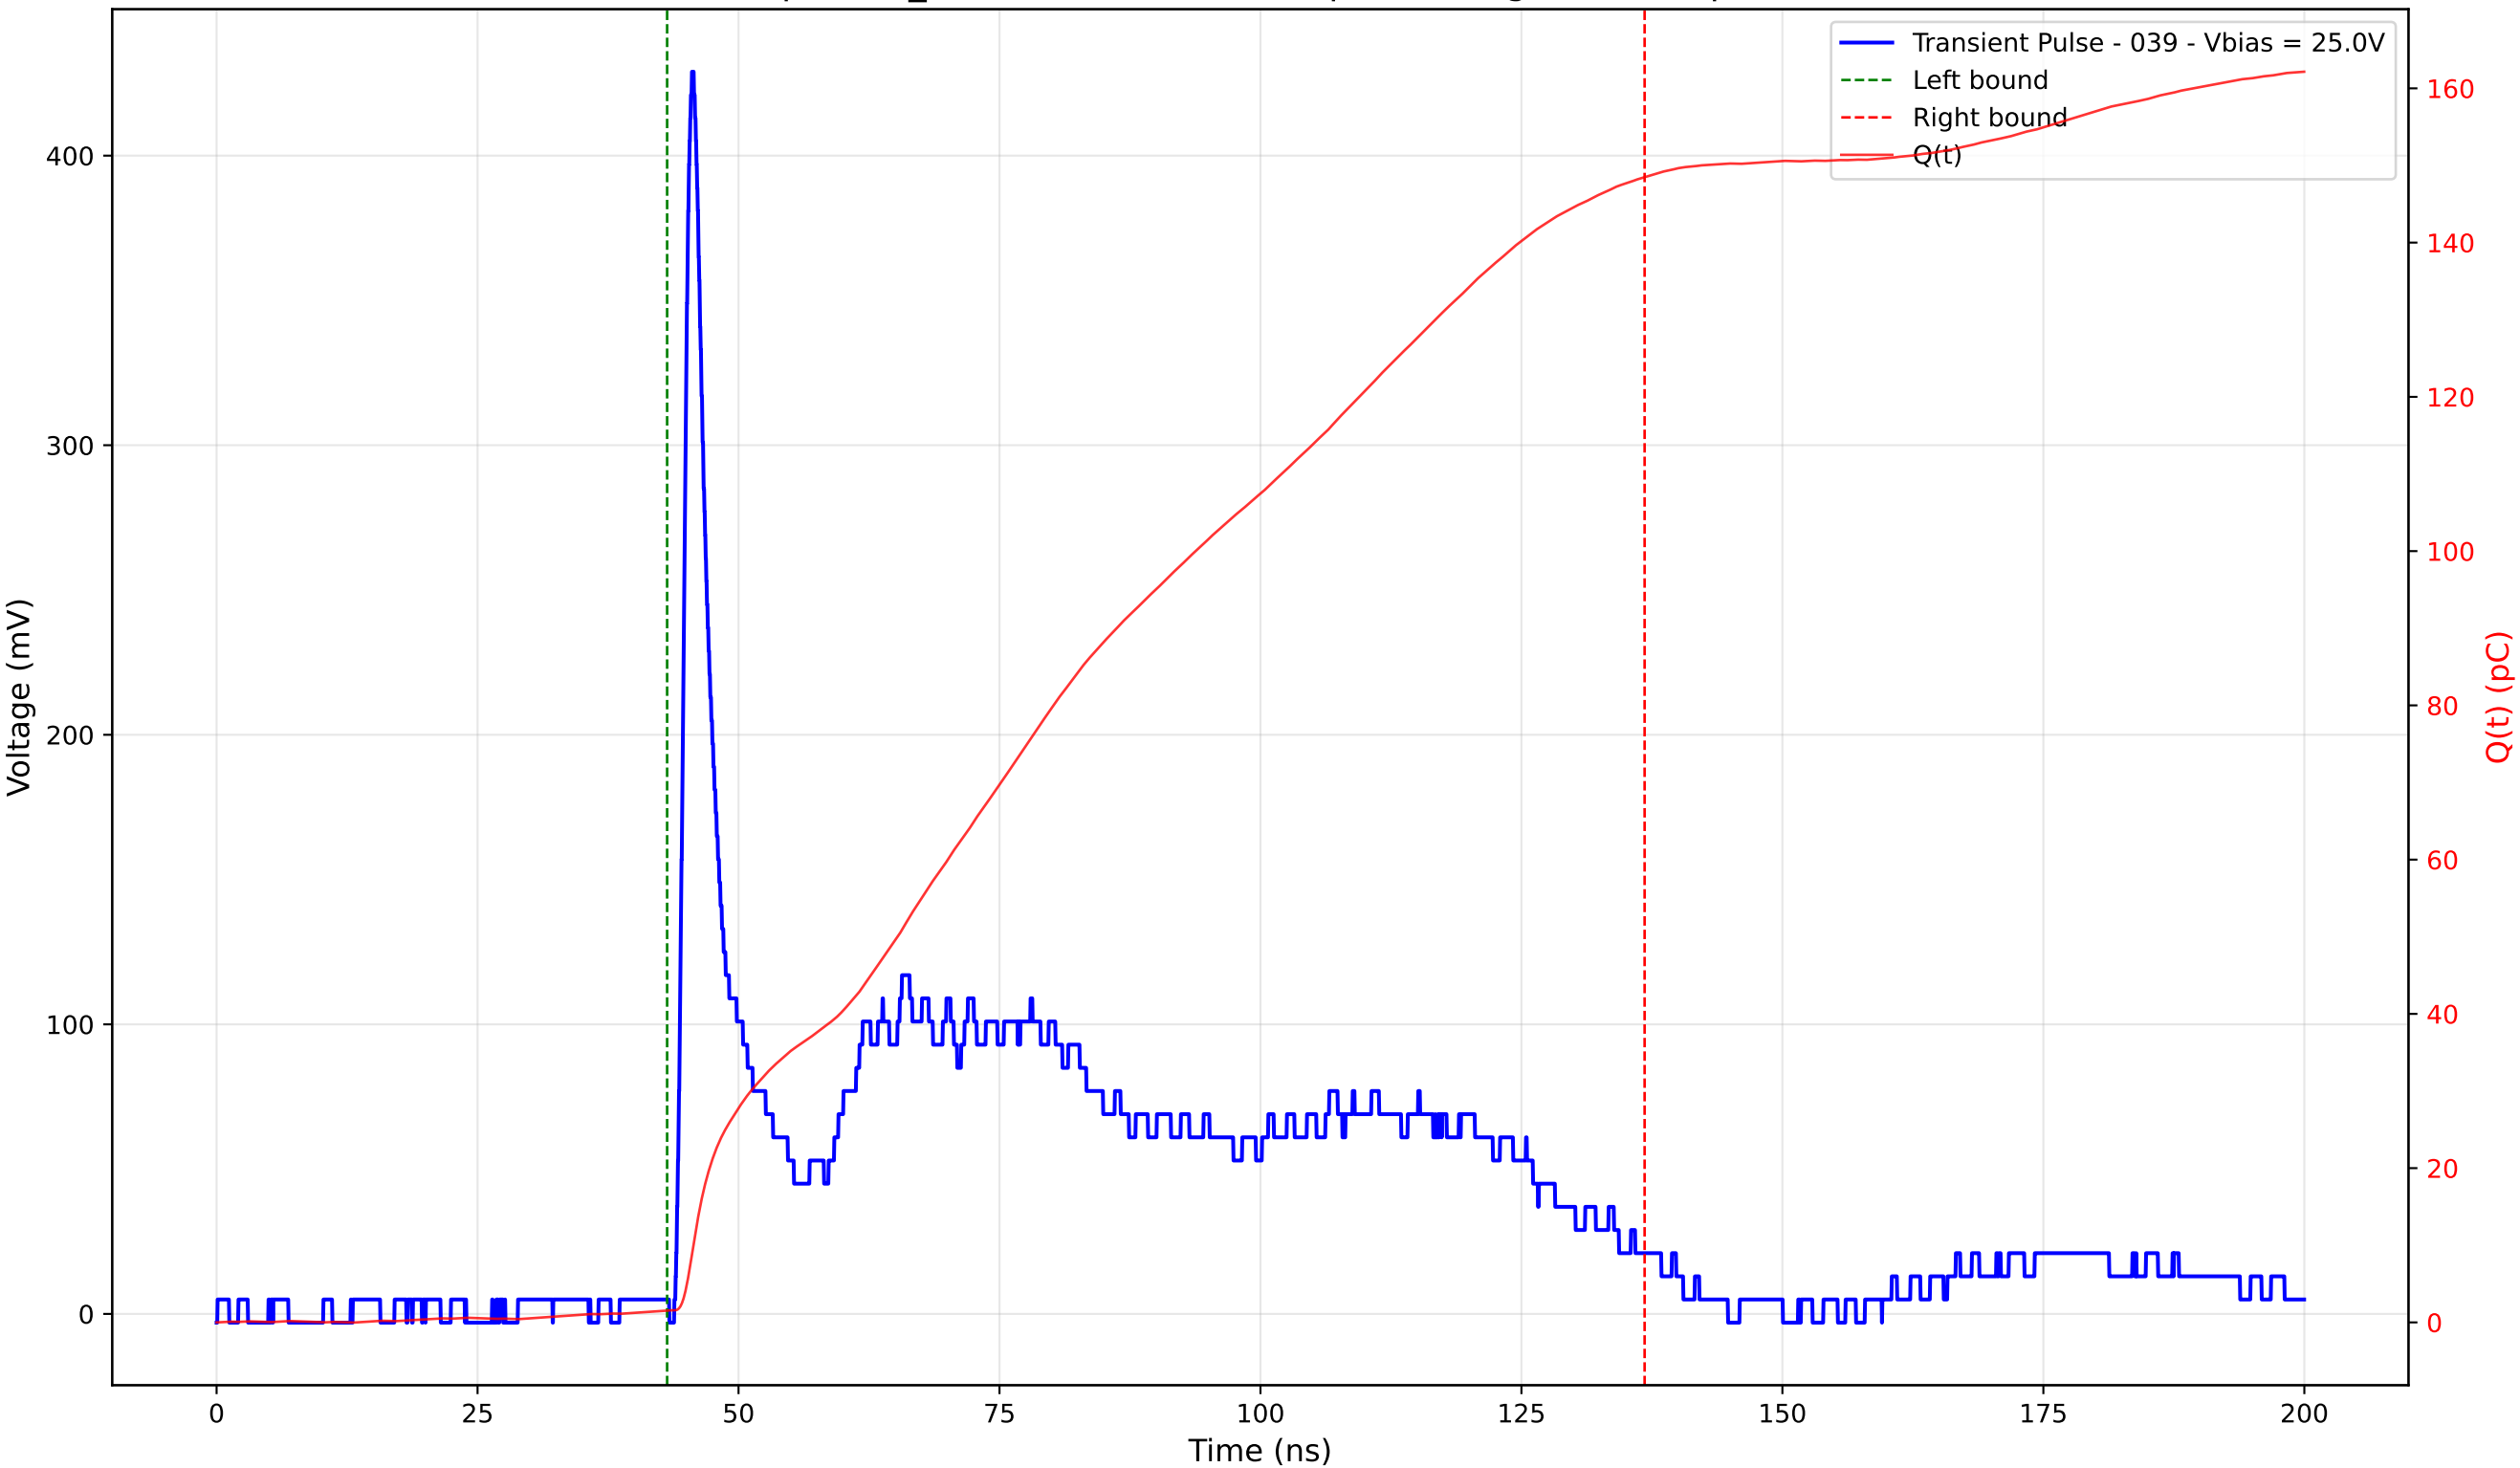


Transient Pulse - Sample: TD_4004 - Position: 110.0 μm - Charge: 137.51 pC - Rise Time: 1.02 ns

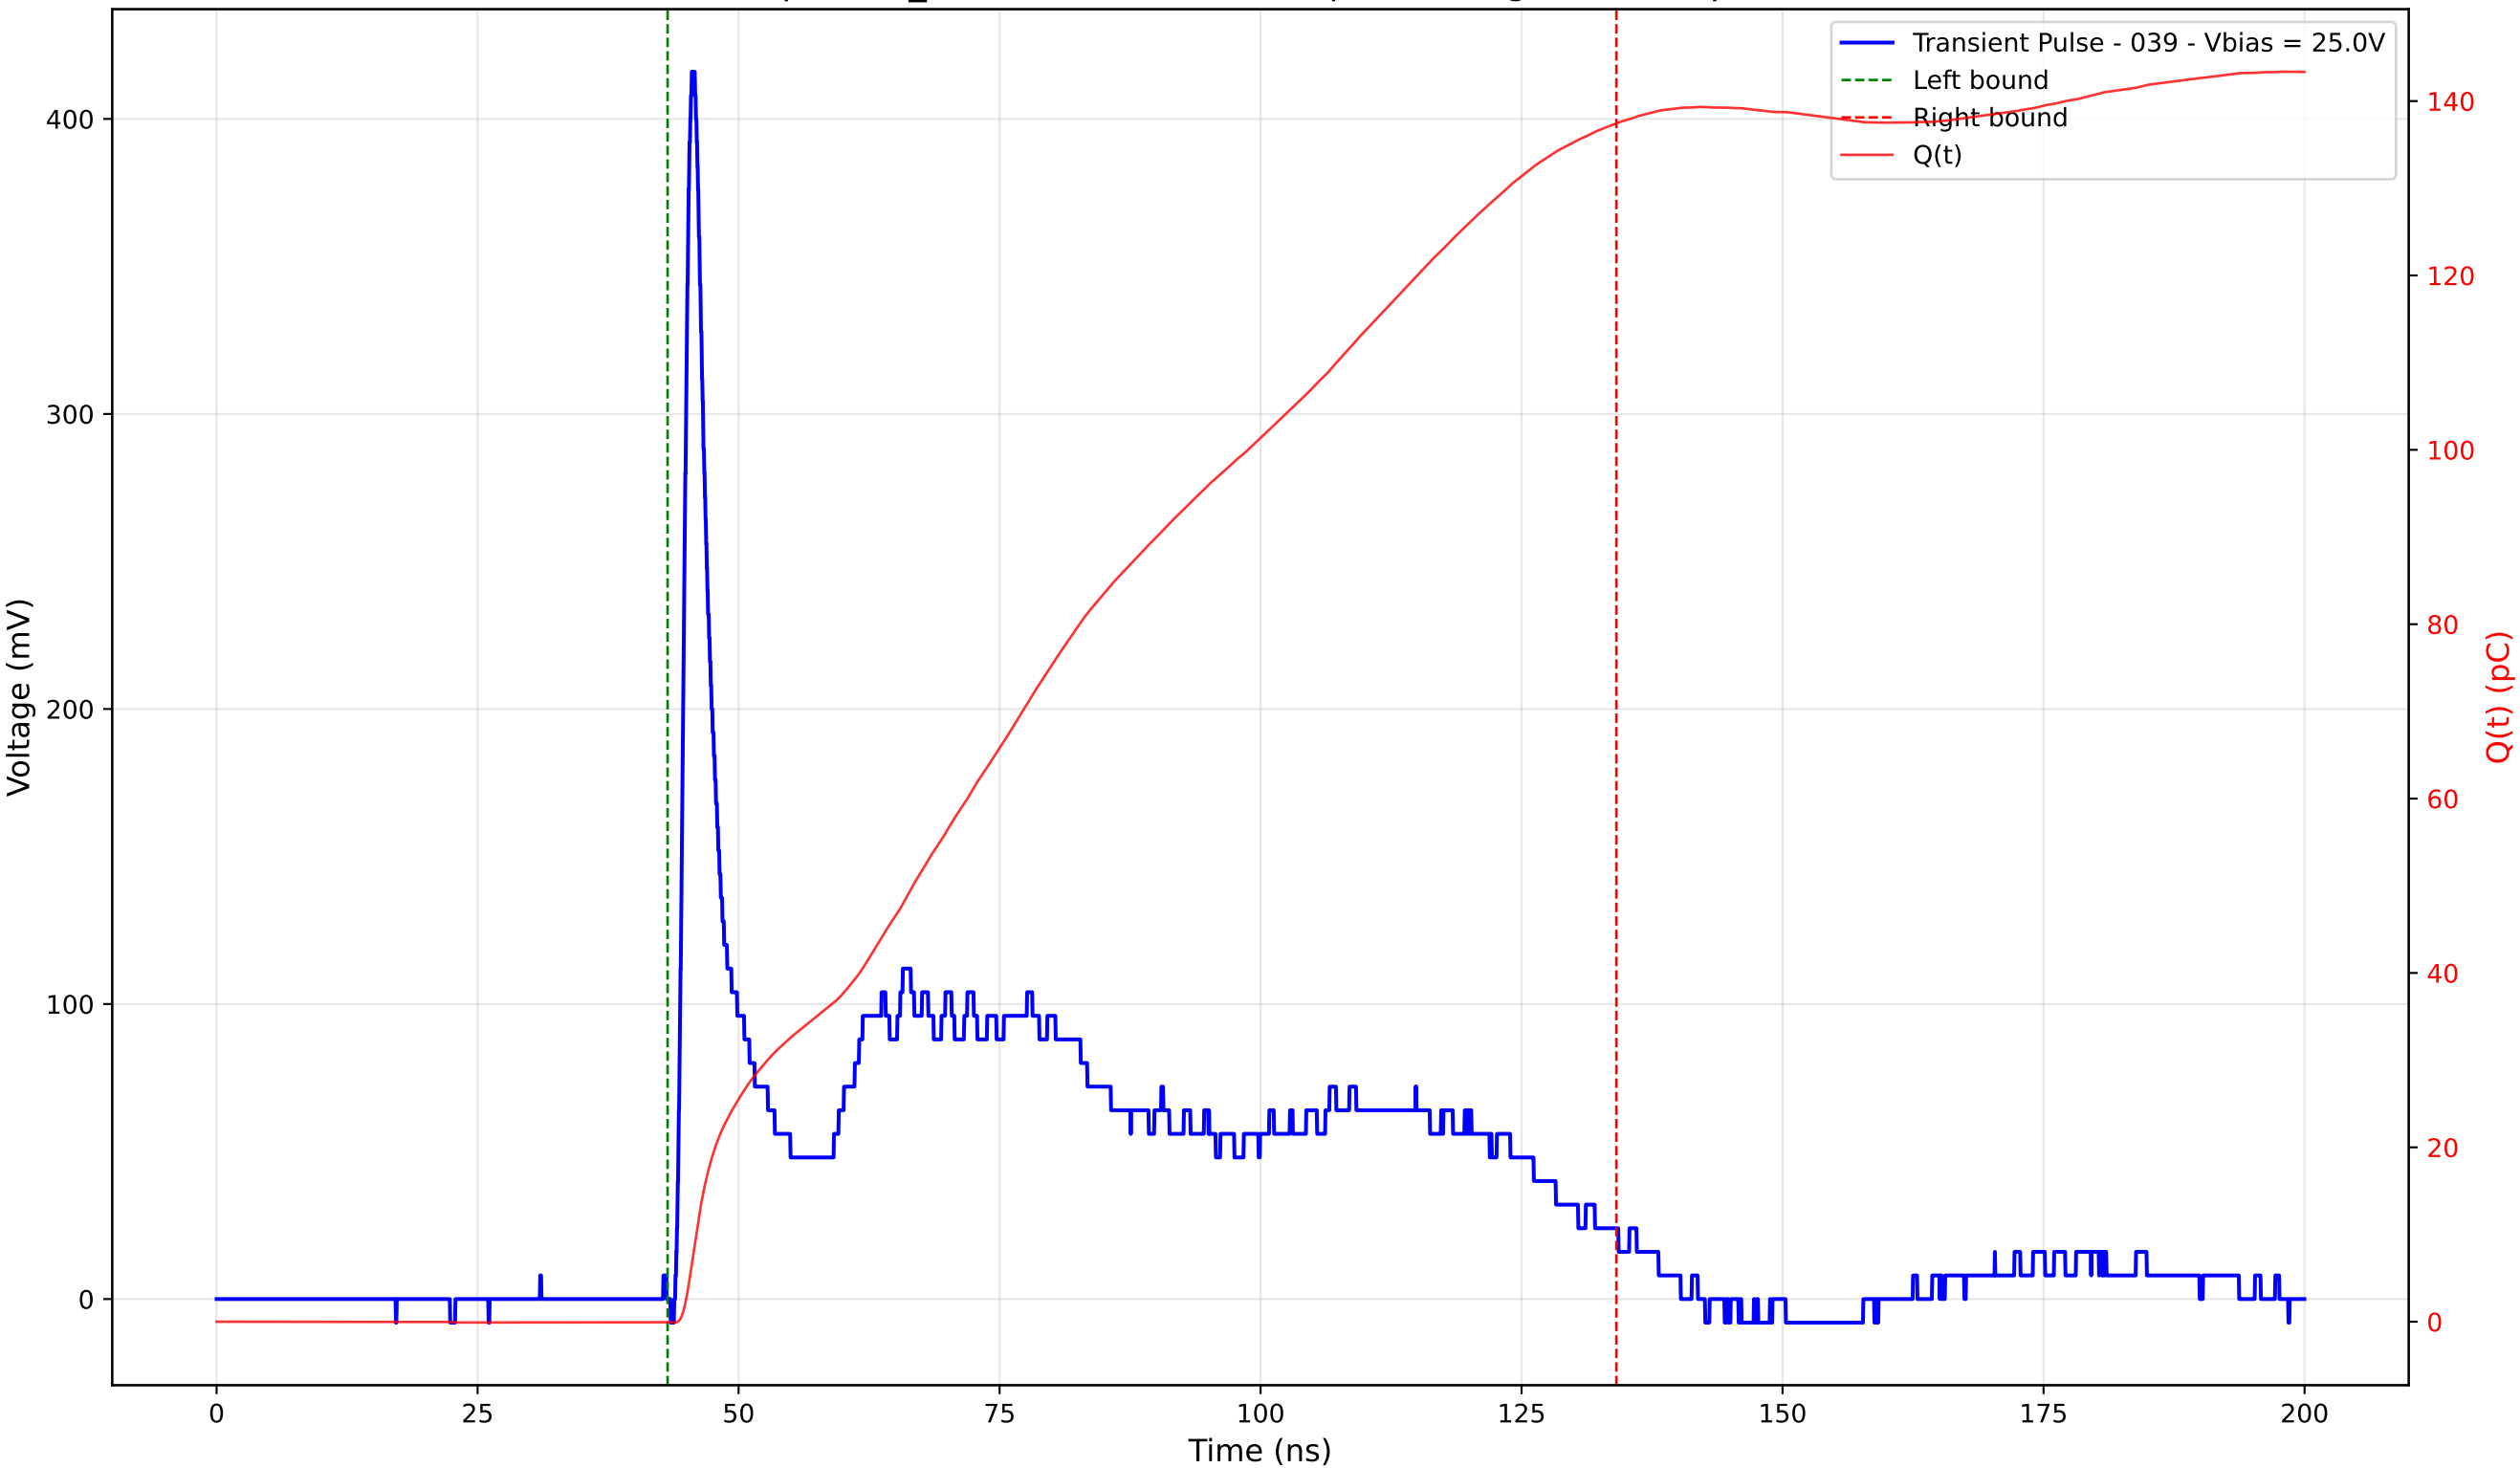


Transient Pulse - Sample: TD_4004 - Position: 115.0 μm - Charge: 143.34 pC - Rise Time: 1.11 ns

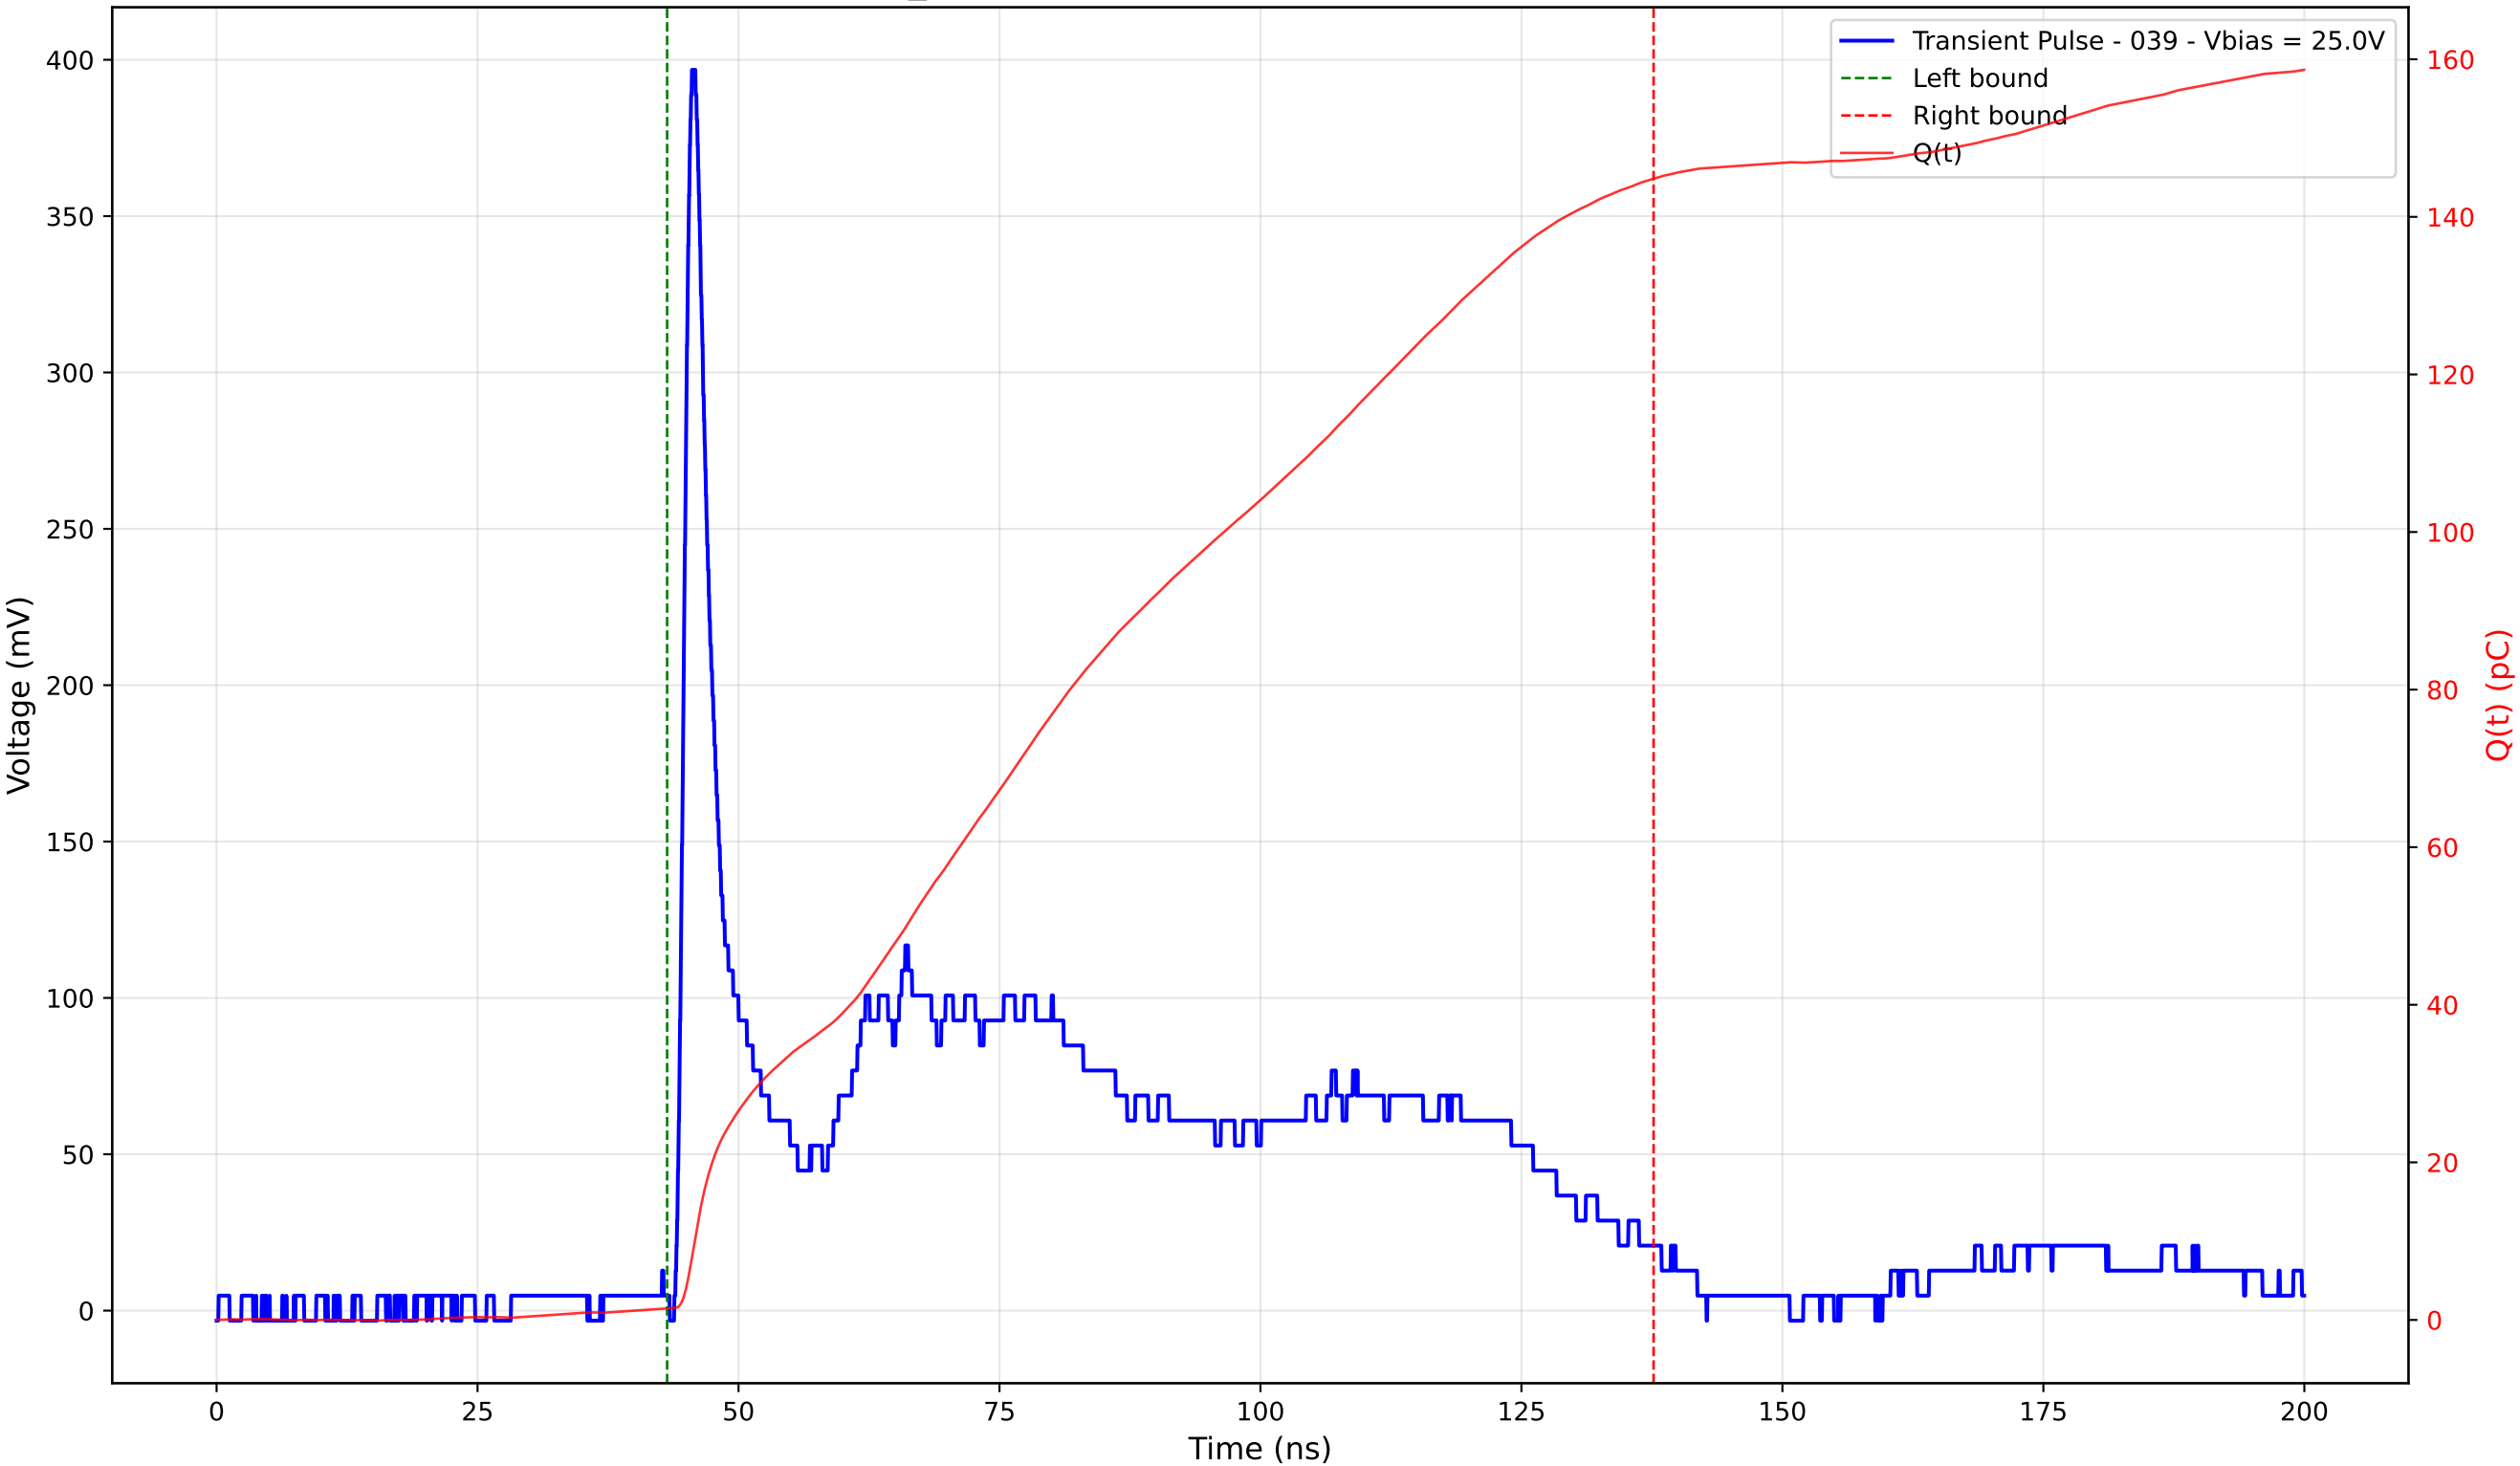


Transient Pulse - Sample: TD_4004 - Position: 120.0 μm - Charge: 130.40 pC - Rise Time: 1.12 ns

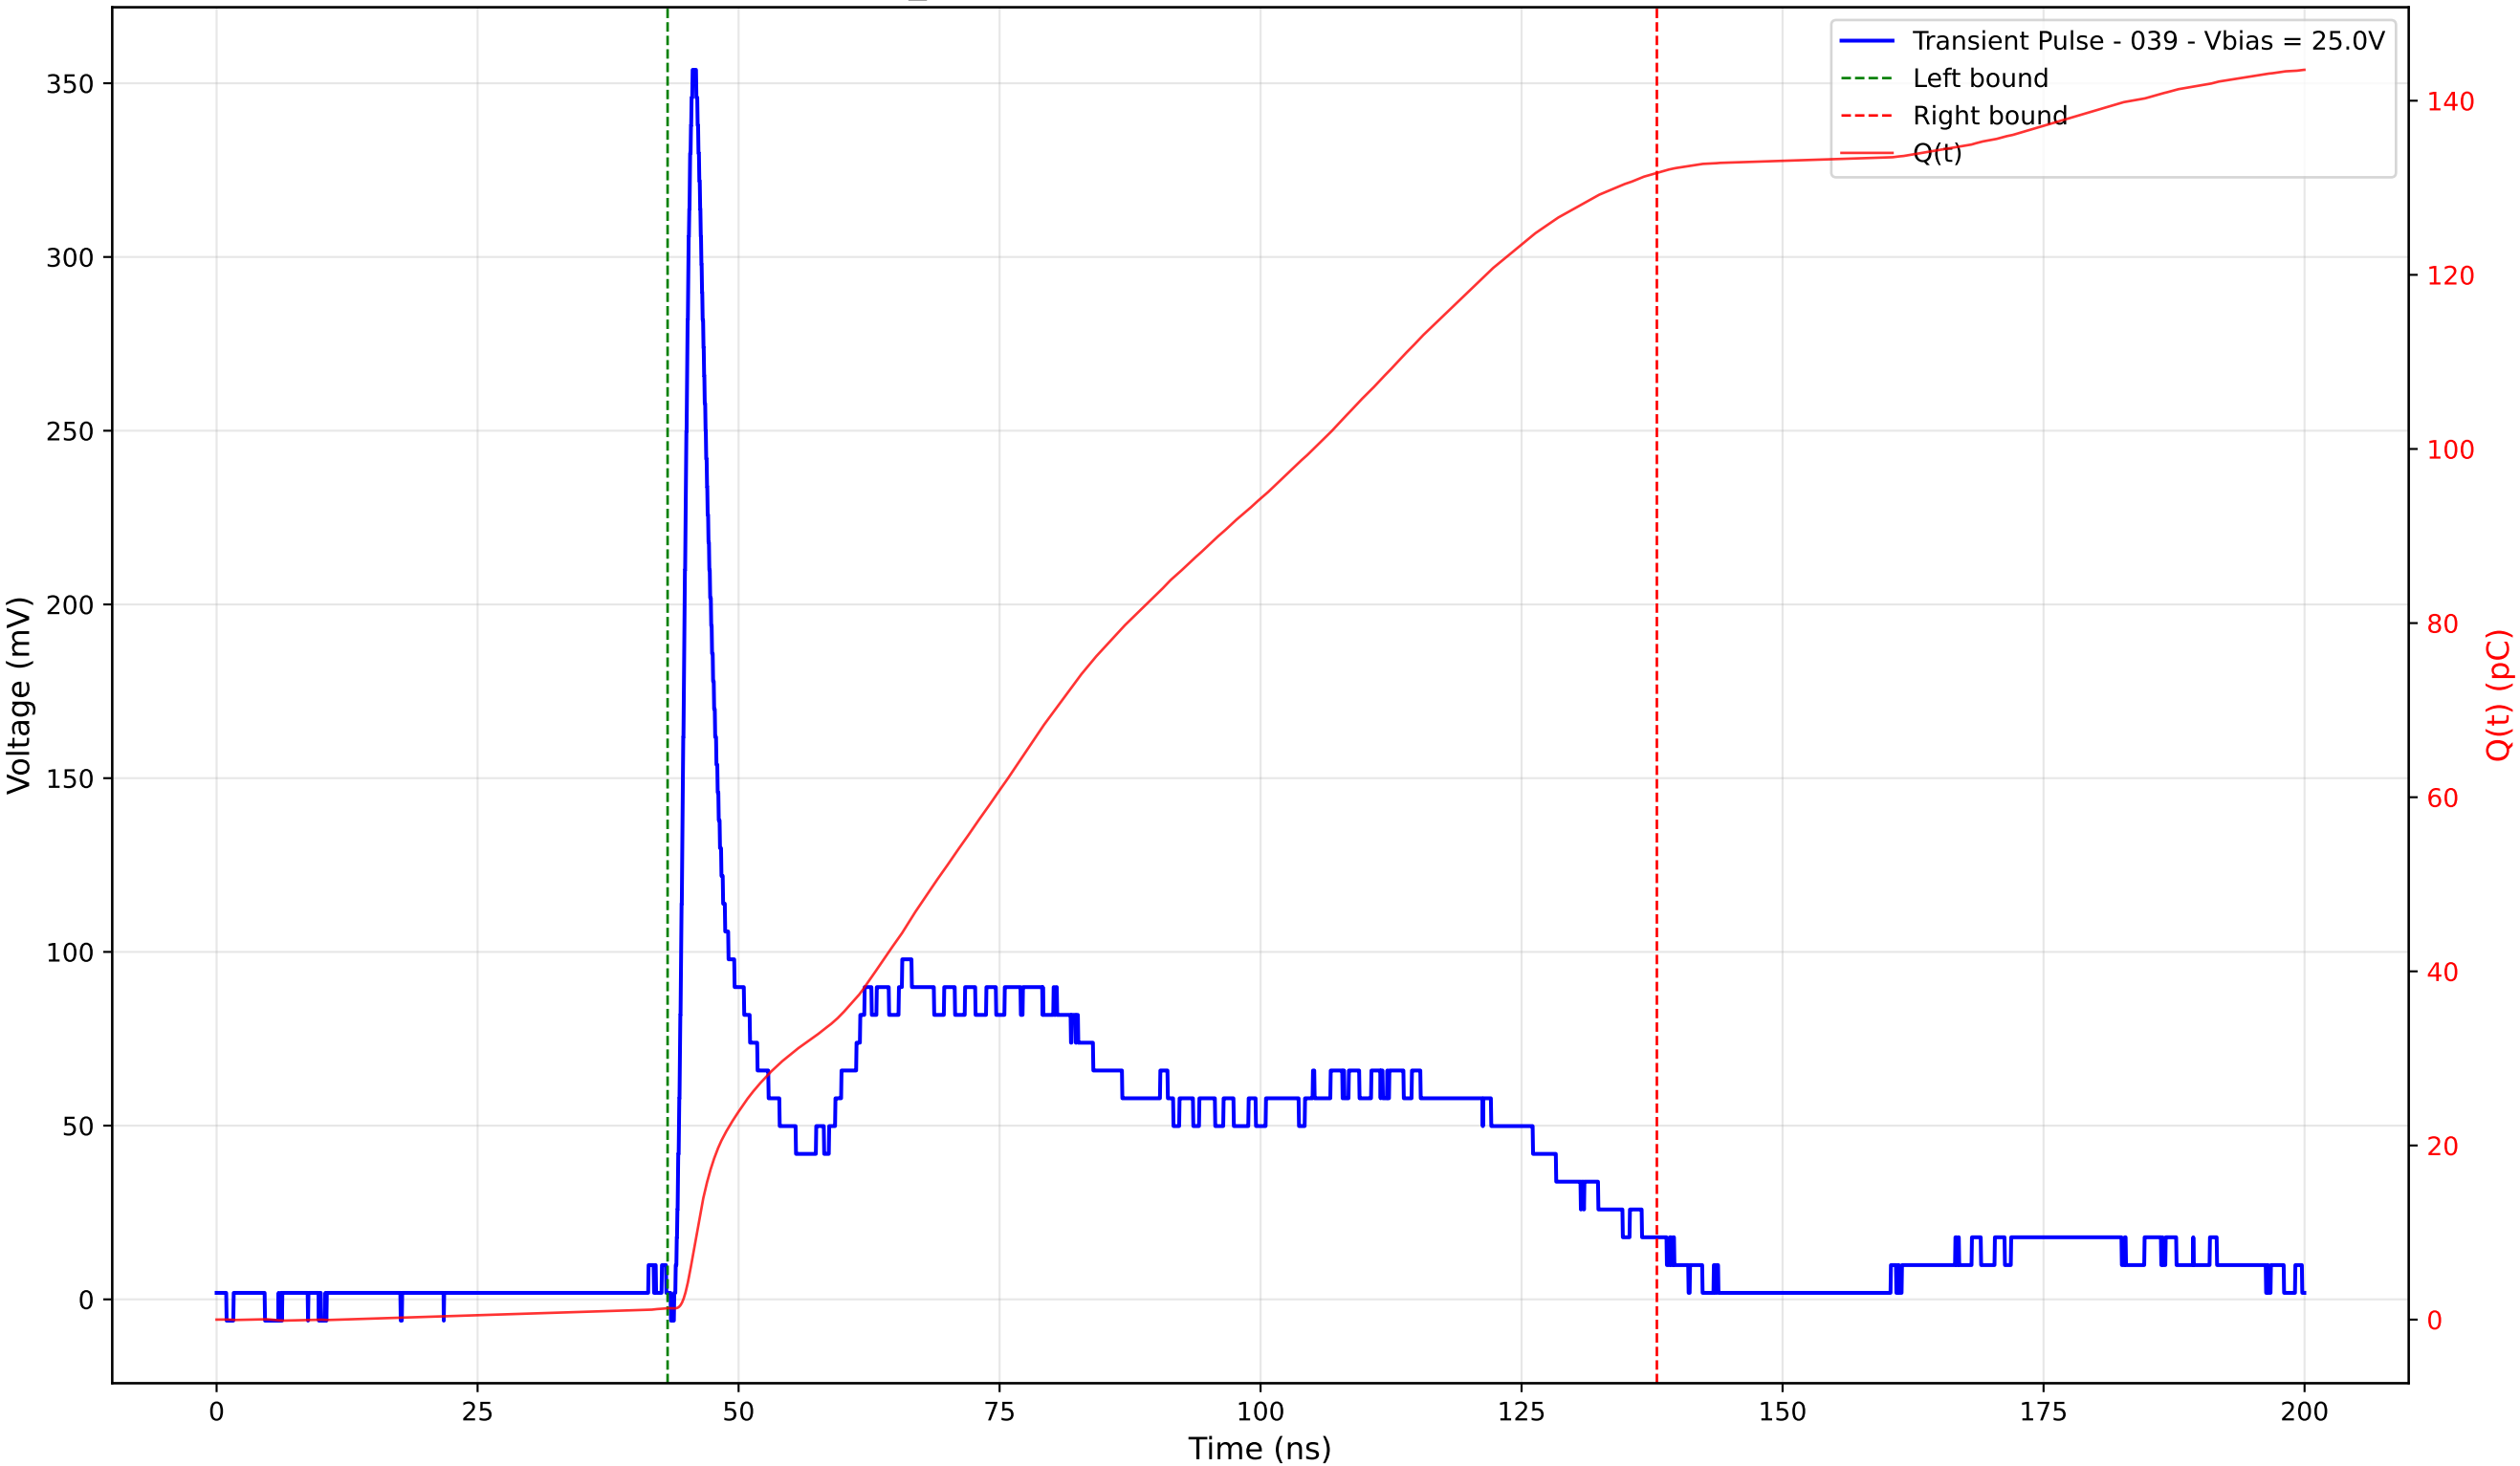


Transient Pulse - Sample: TD_4004 - Position: 125.0 μm - Charge: 114.76 pC - Rise Time: 1.15 ns

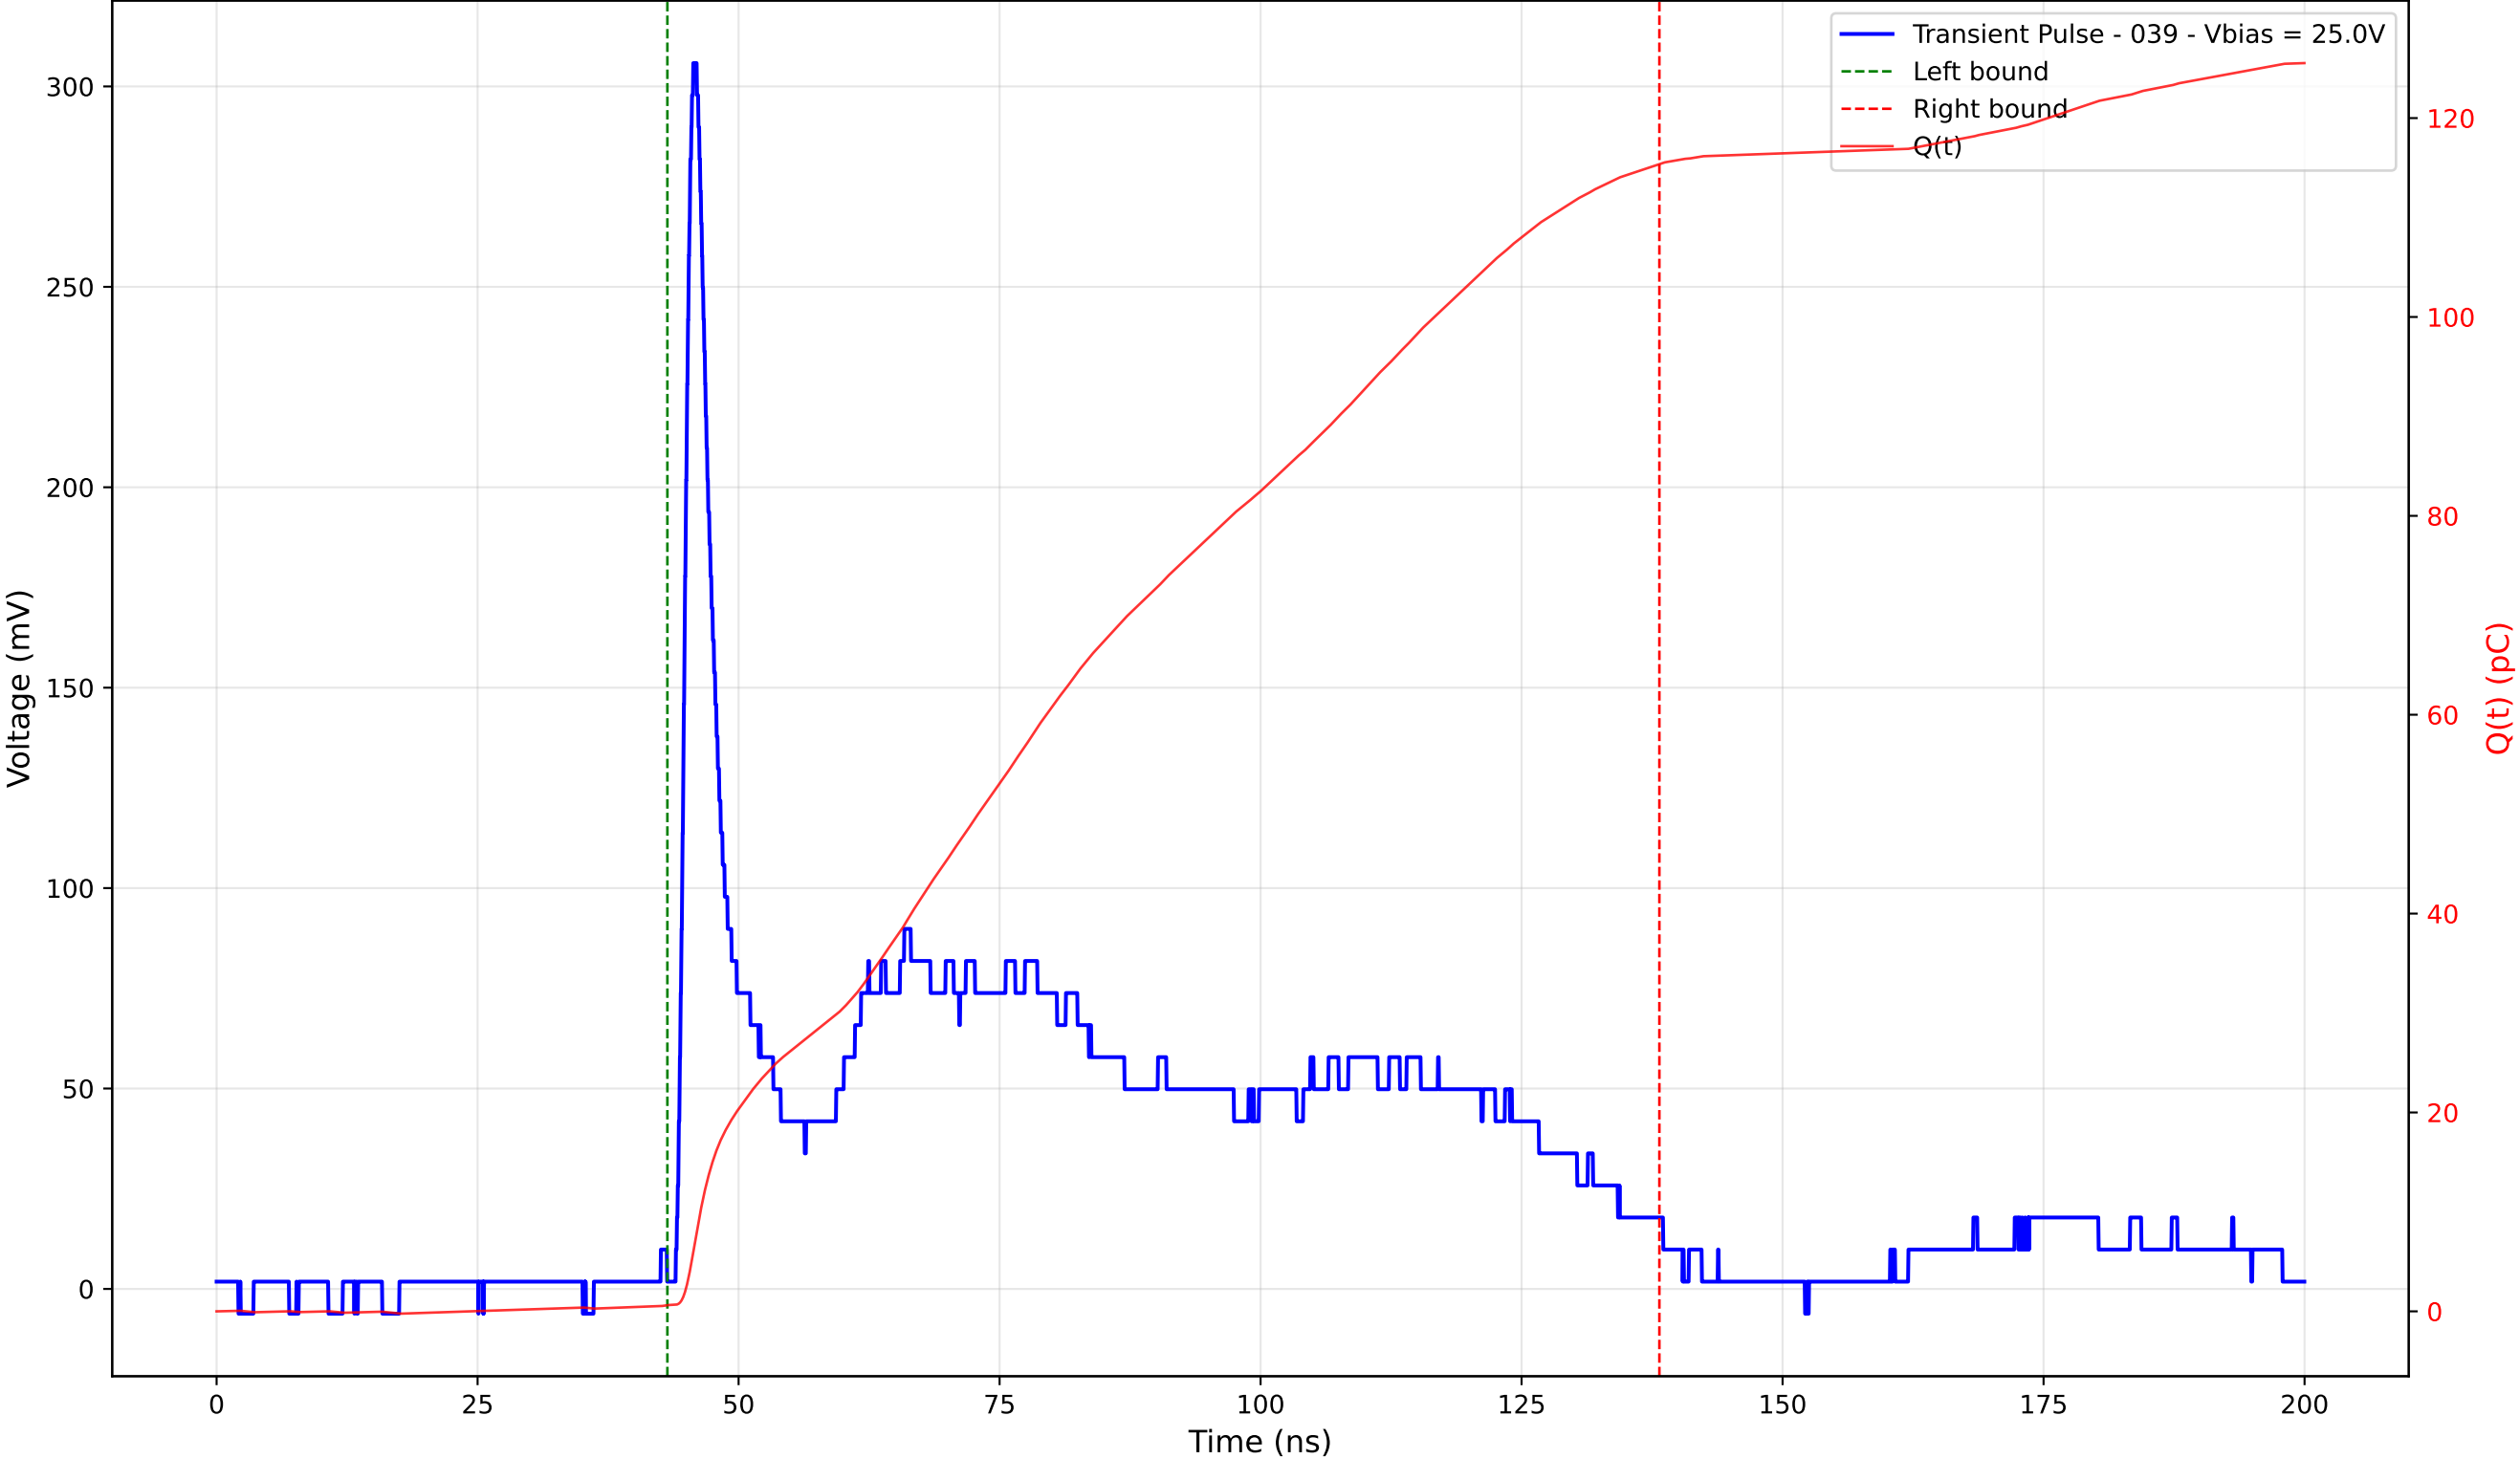


Transient Pulse - Sample: TD_4004 - Position: 130.0 μm - Charge: 92.23 pC - Rise Time: 1.17 ns

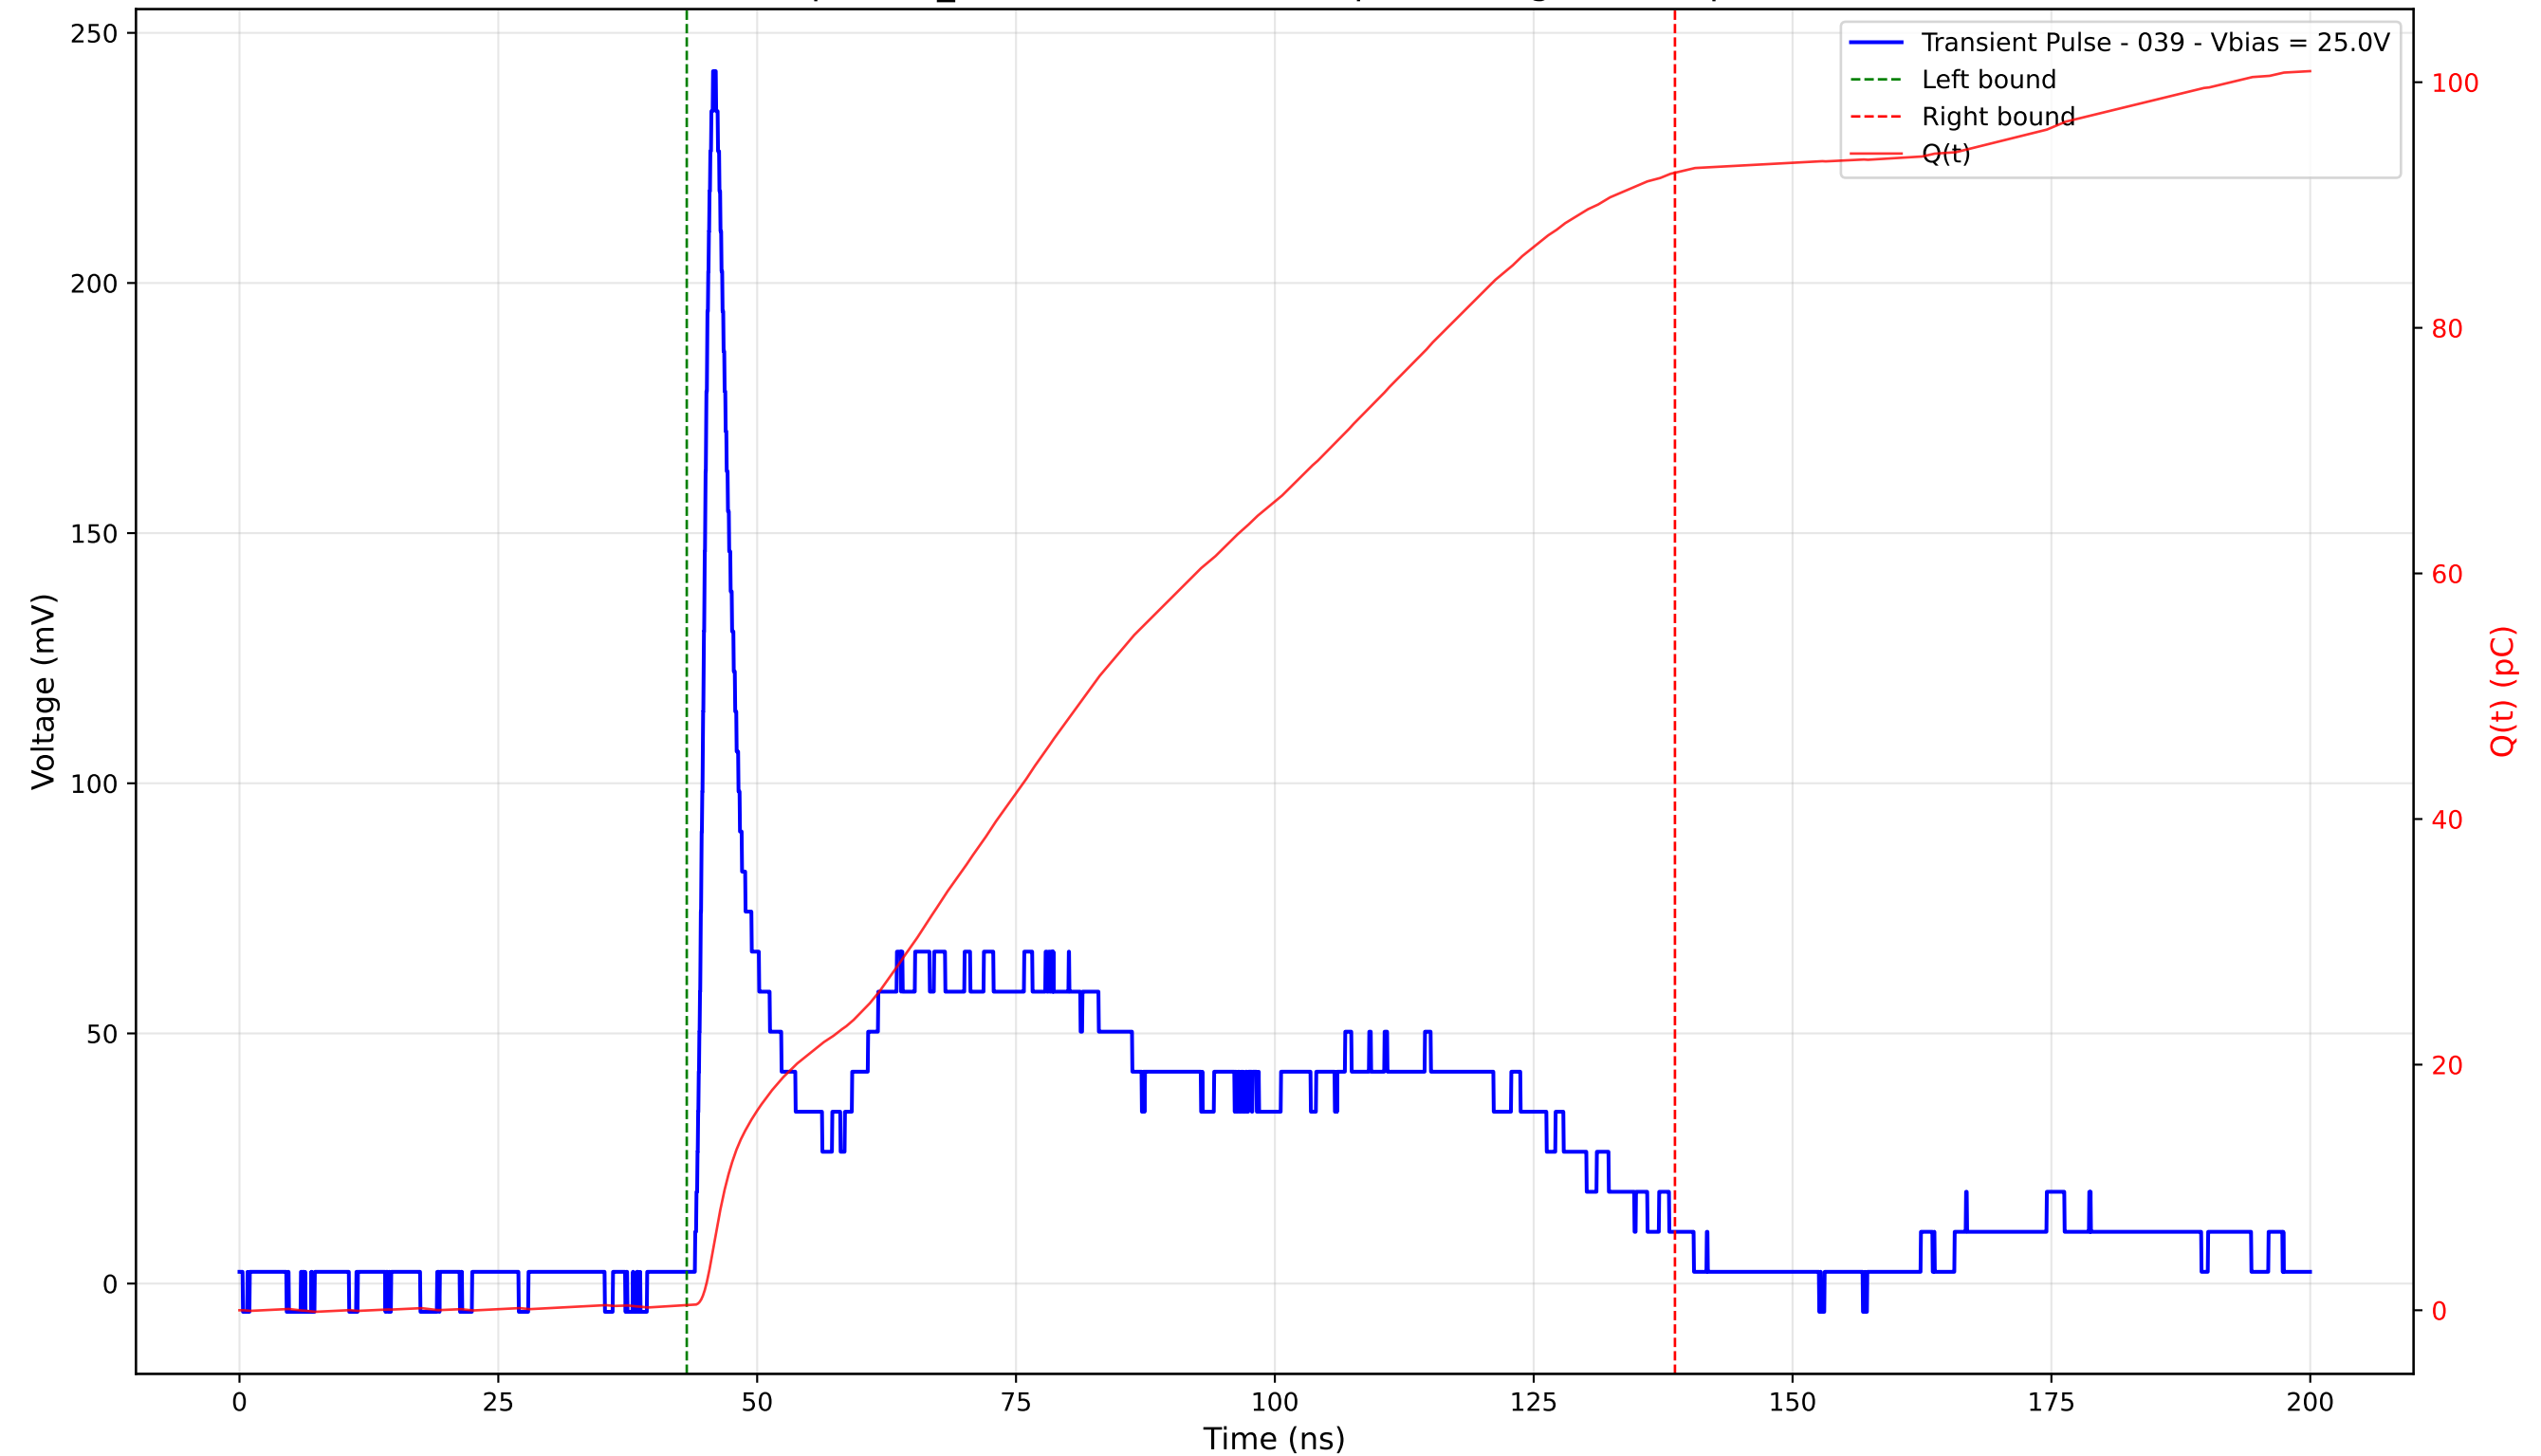


Transient Pulse - Sample: TD_4004 - Position: 135.0 μm - Charge: 81.53 pC - Rise Time: 1.21 ns

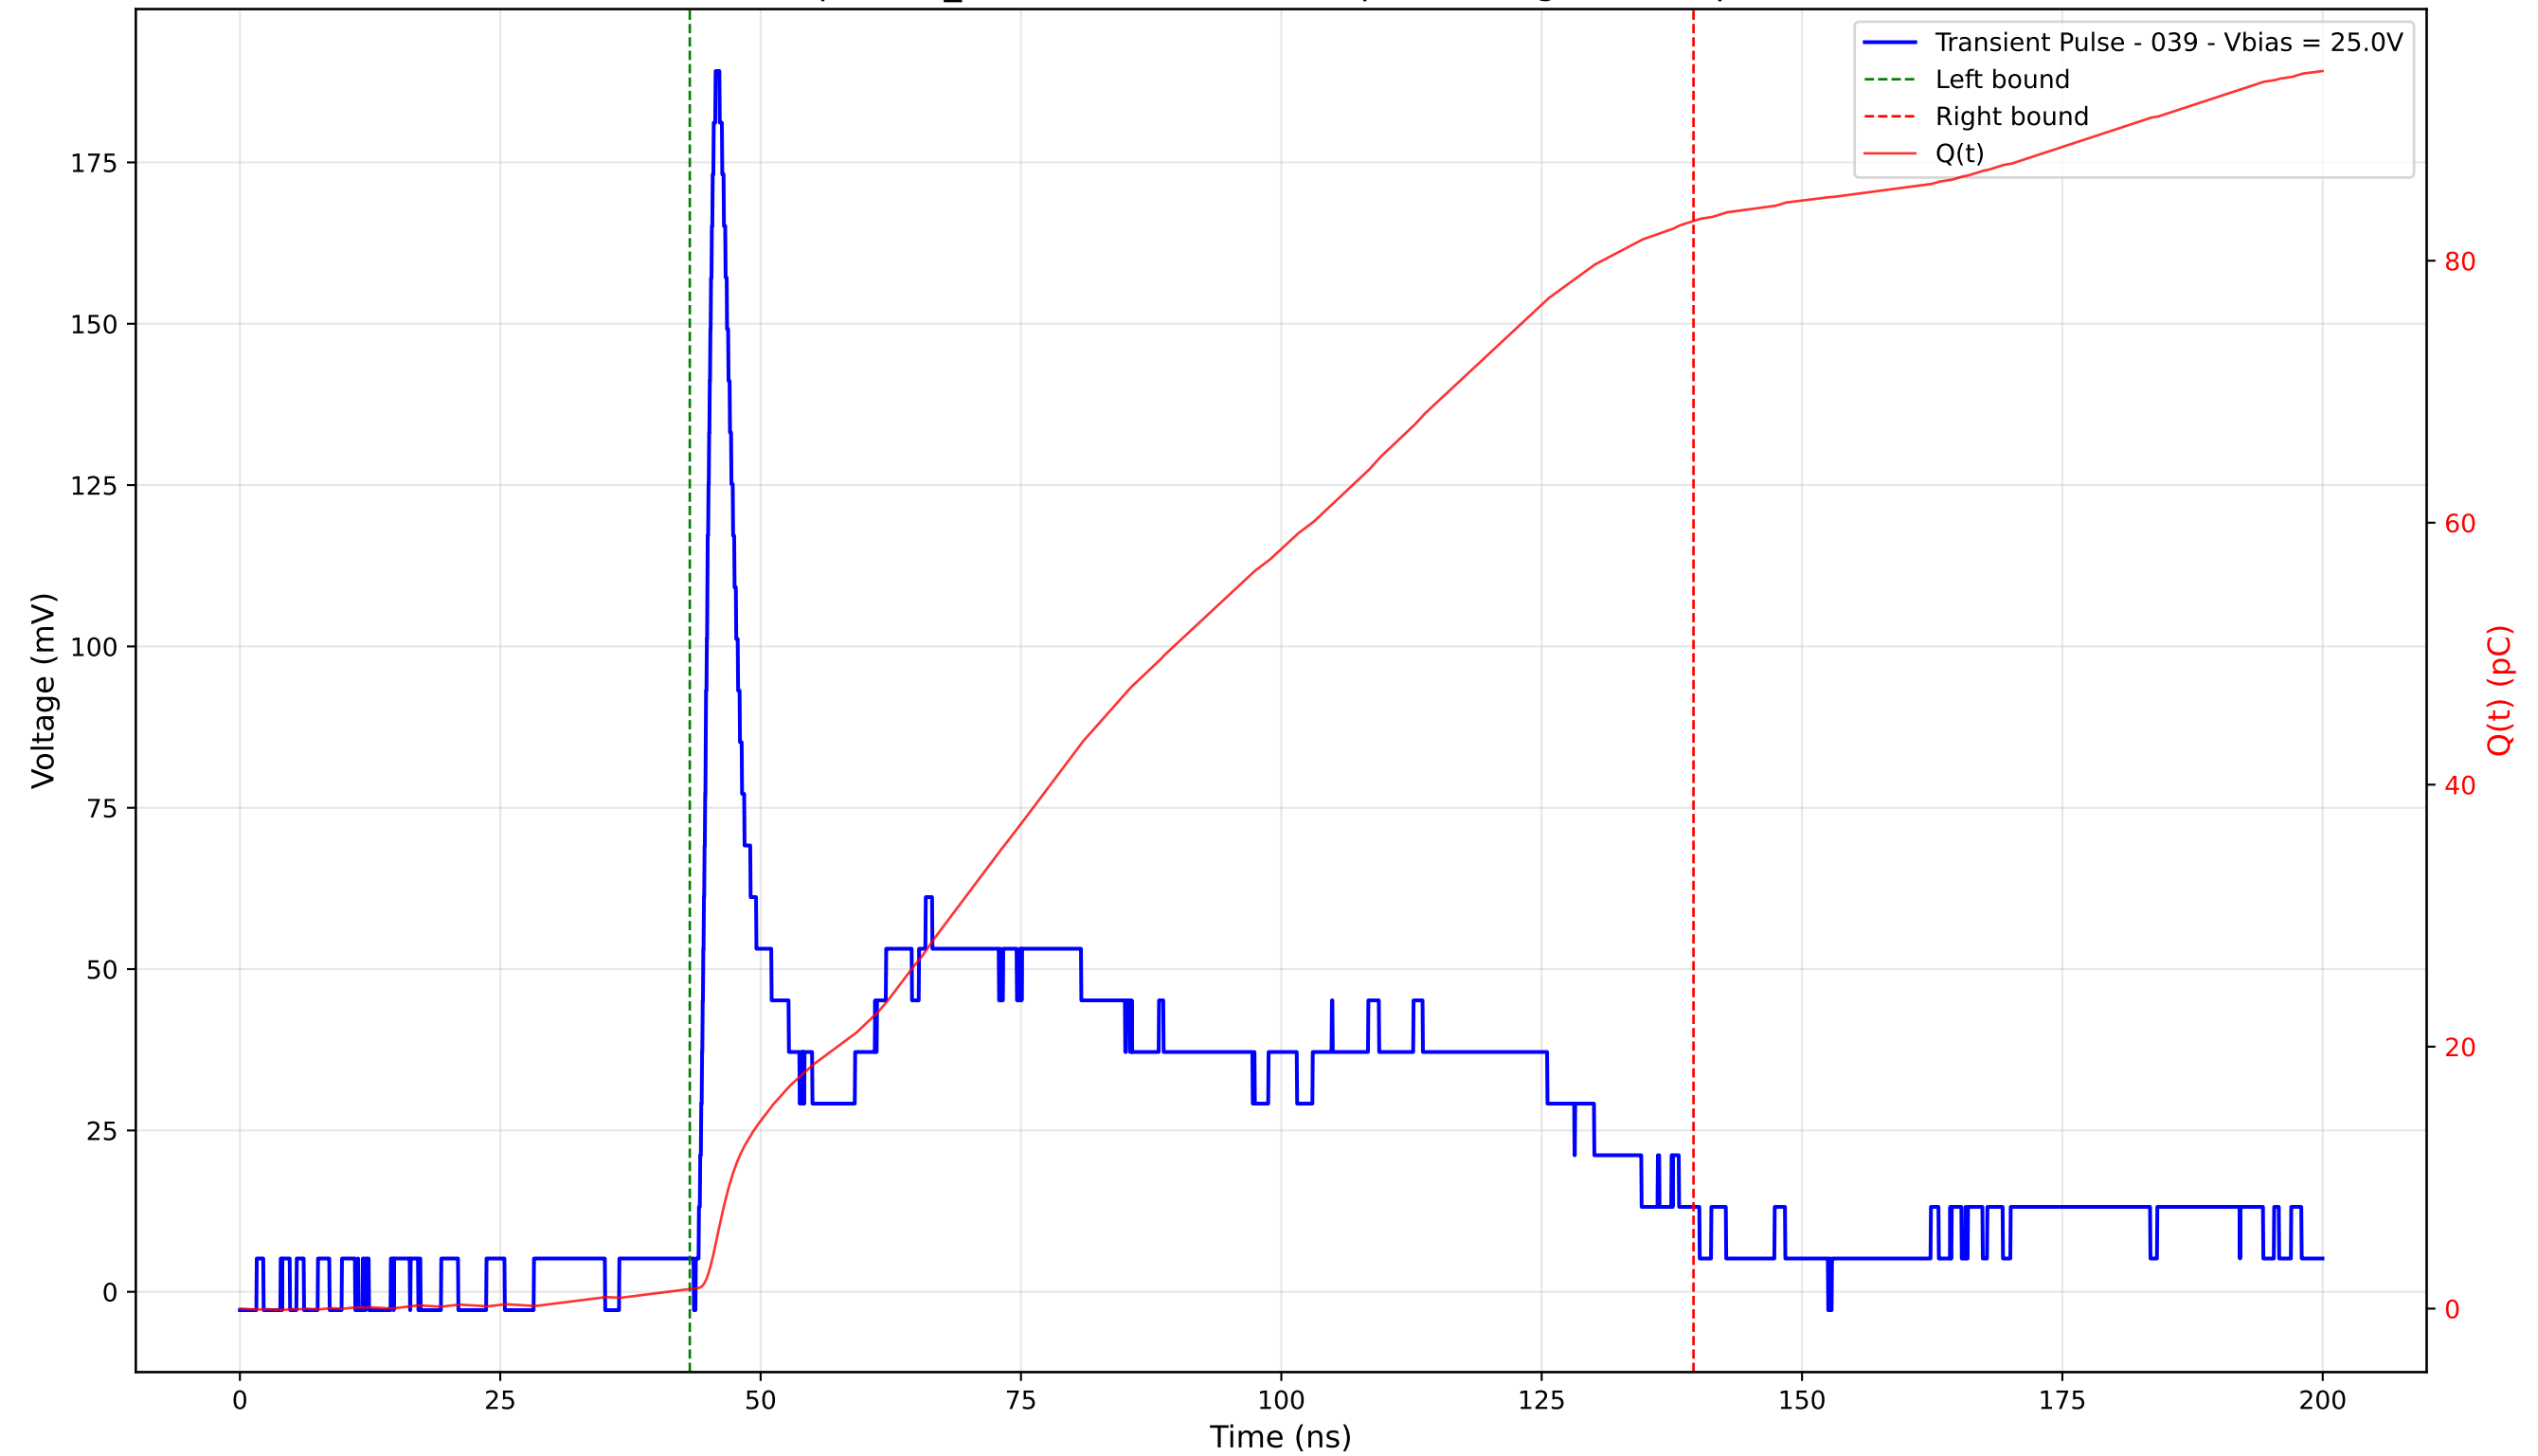


Transient Pulse - Sample: TD_4004 - Position: 140.0 μm - Charge: 75.22 pC - Rise Time: 1.34 ns

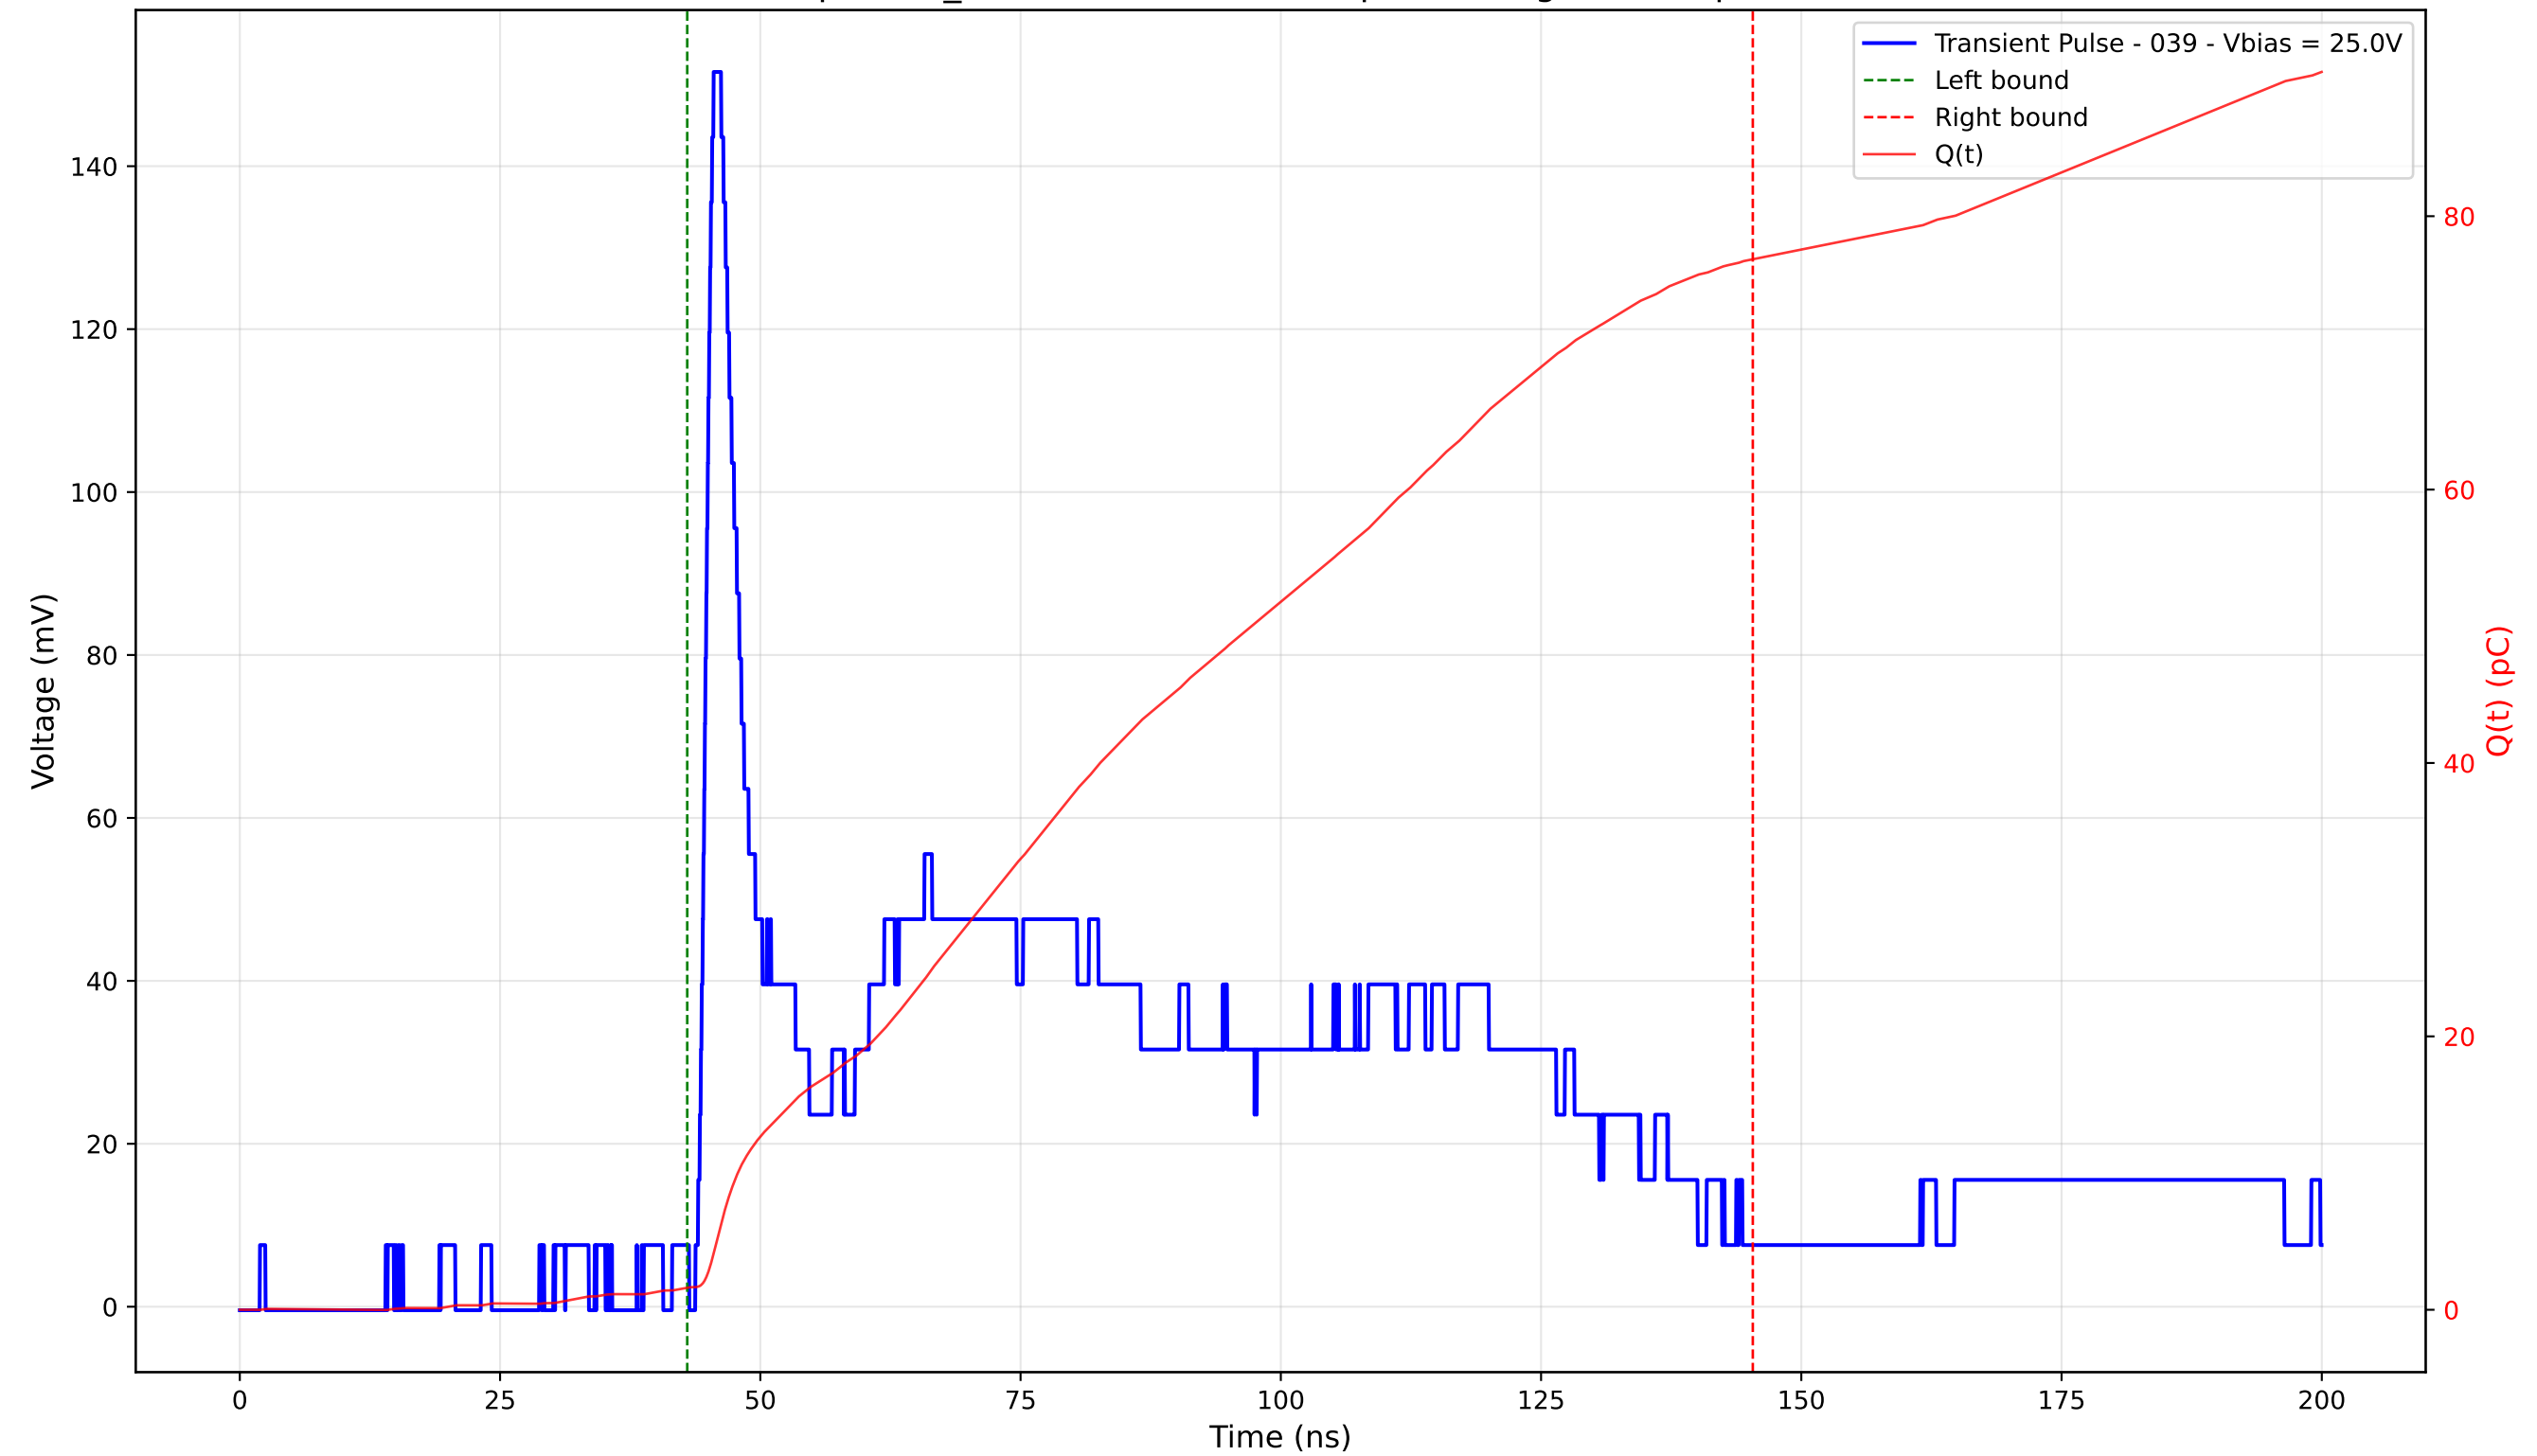


Transient Pulse - Sample: TD_4004 - Position: 145.0 μm - Charge: 66.03 pC - Rise Time: 1.29 ns

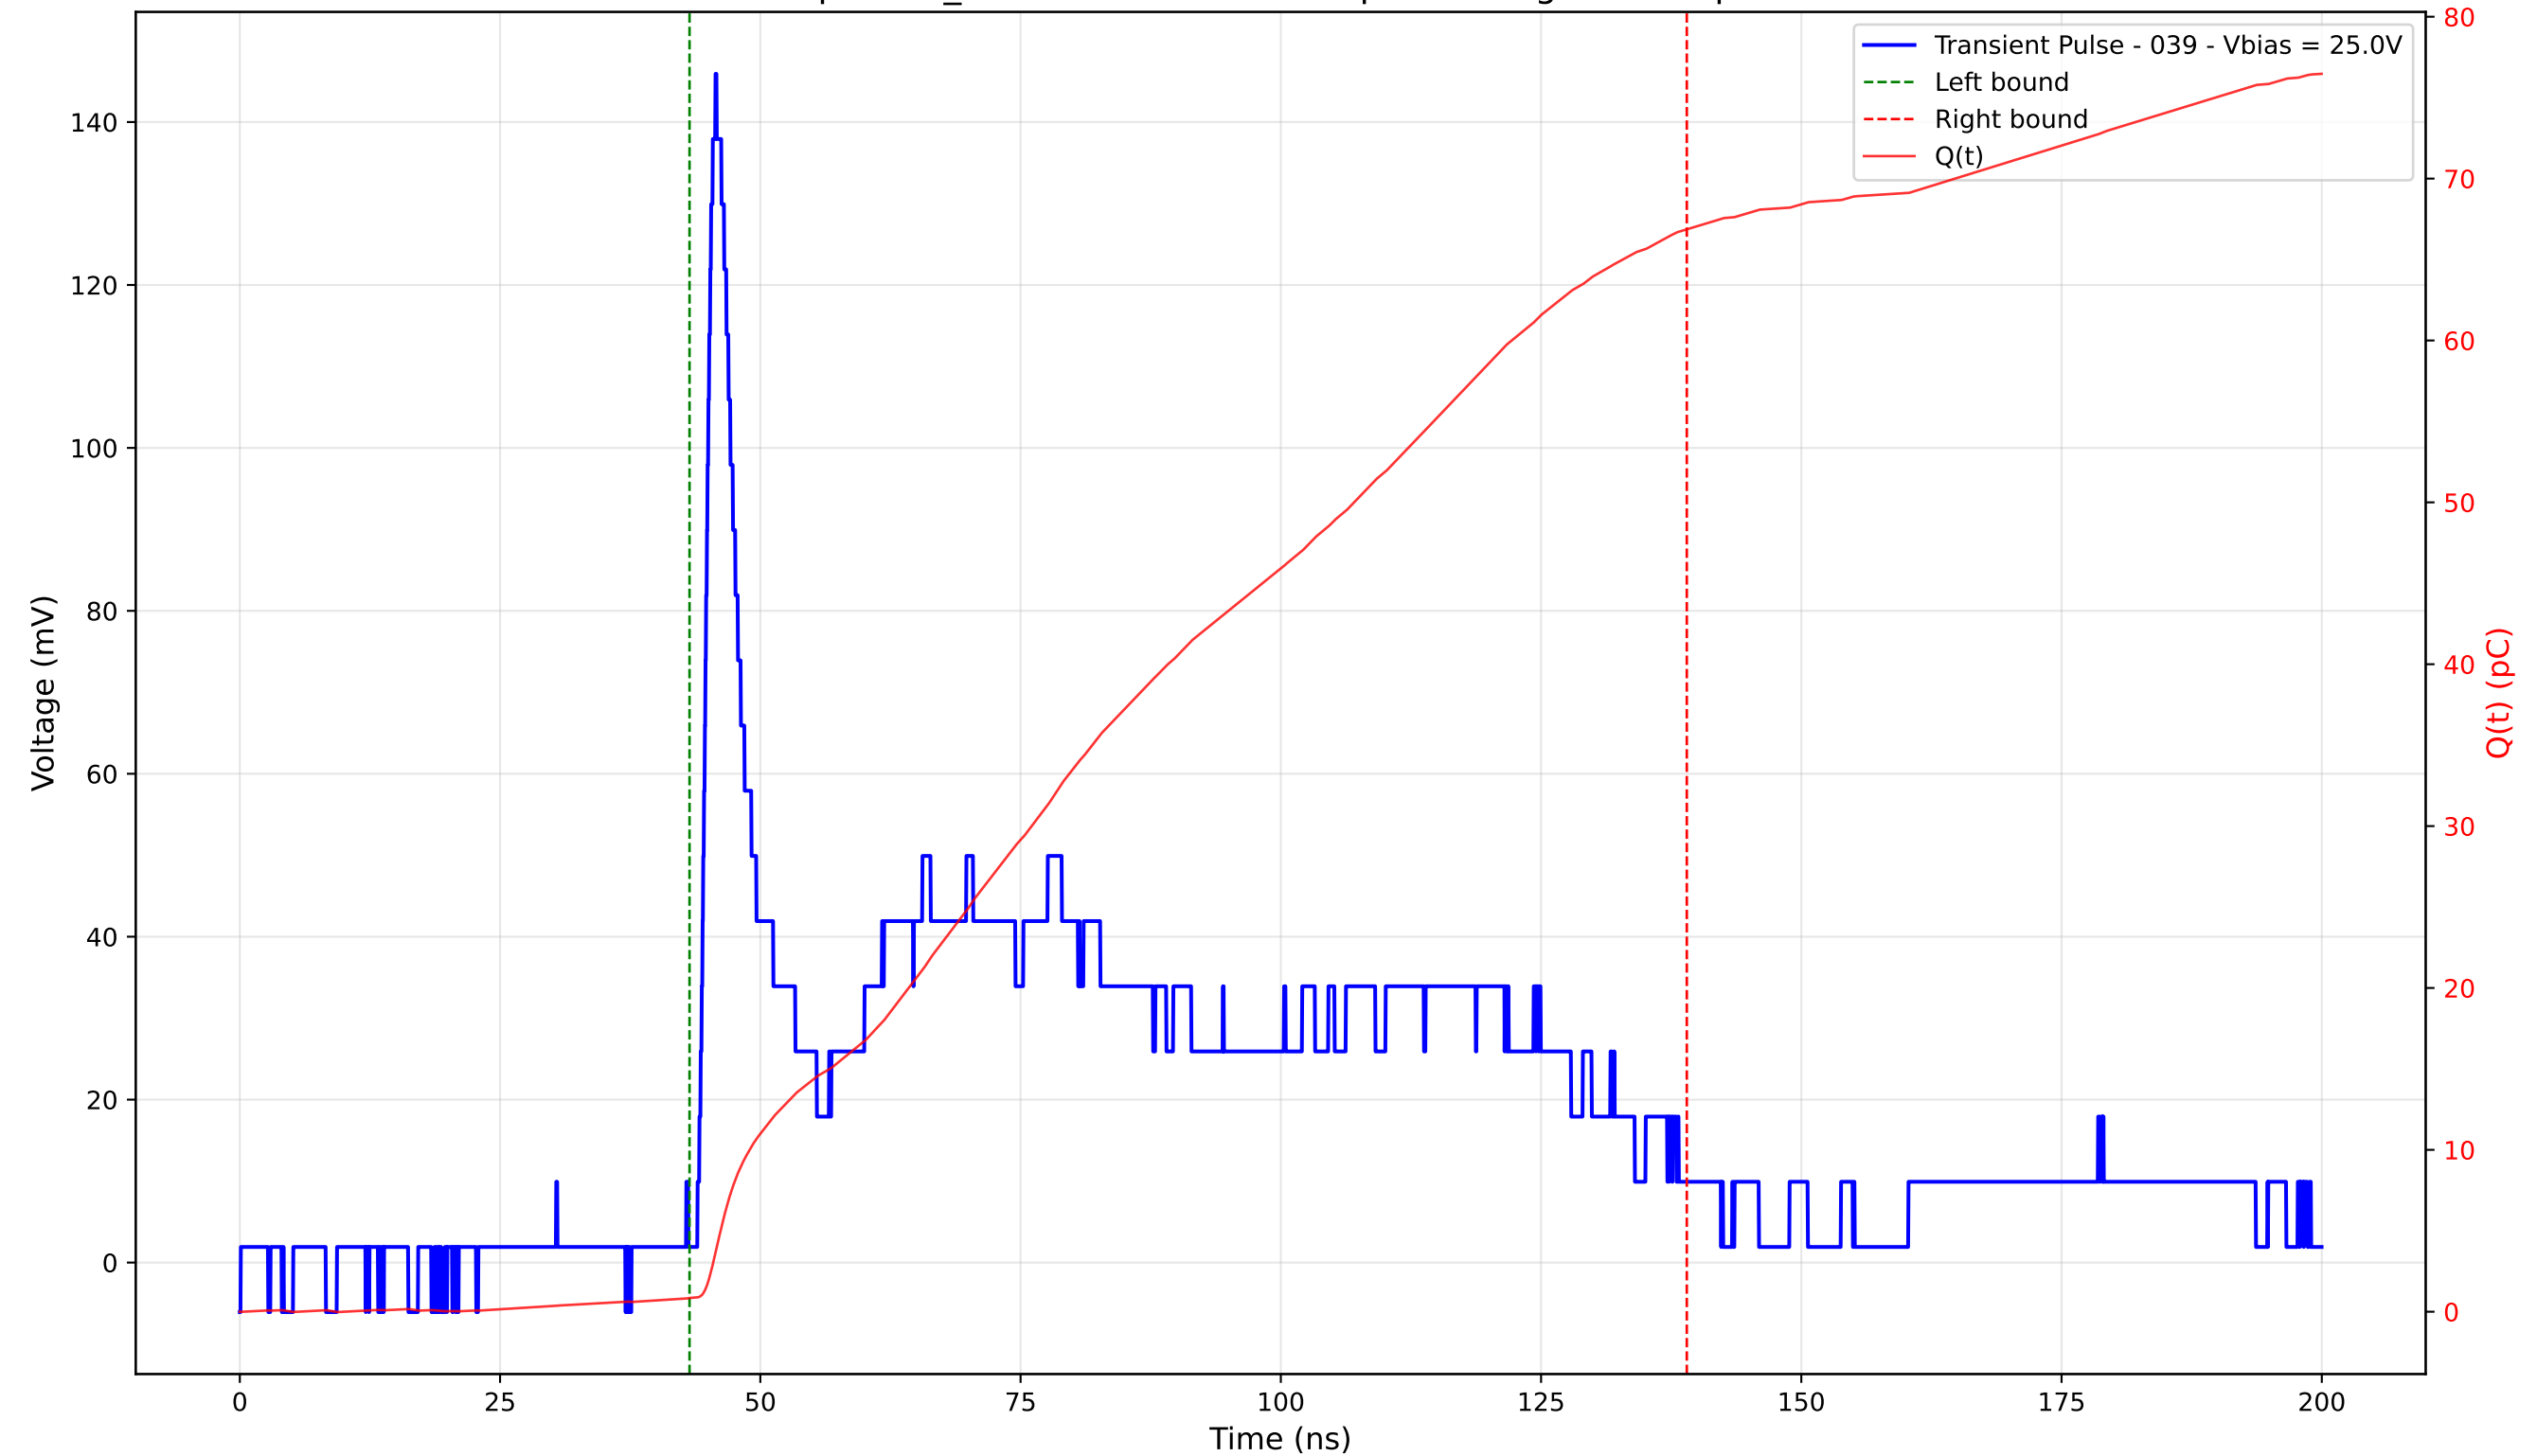


Transient Pulse - Sample: TD_4004 - Position: 150.0 μm - Charge: 86.95 pC - Rise Time: 1.26 ns

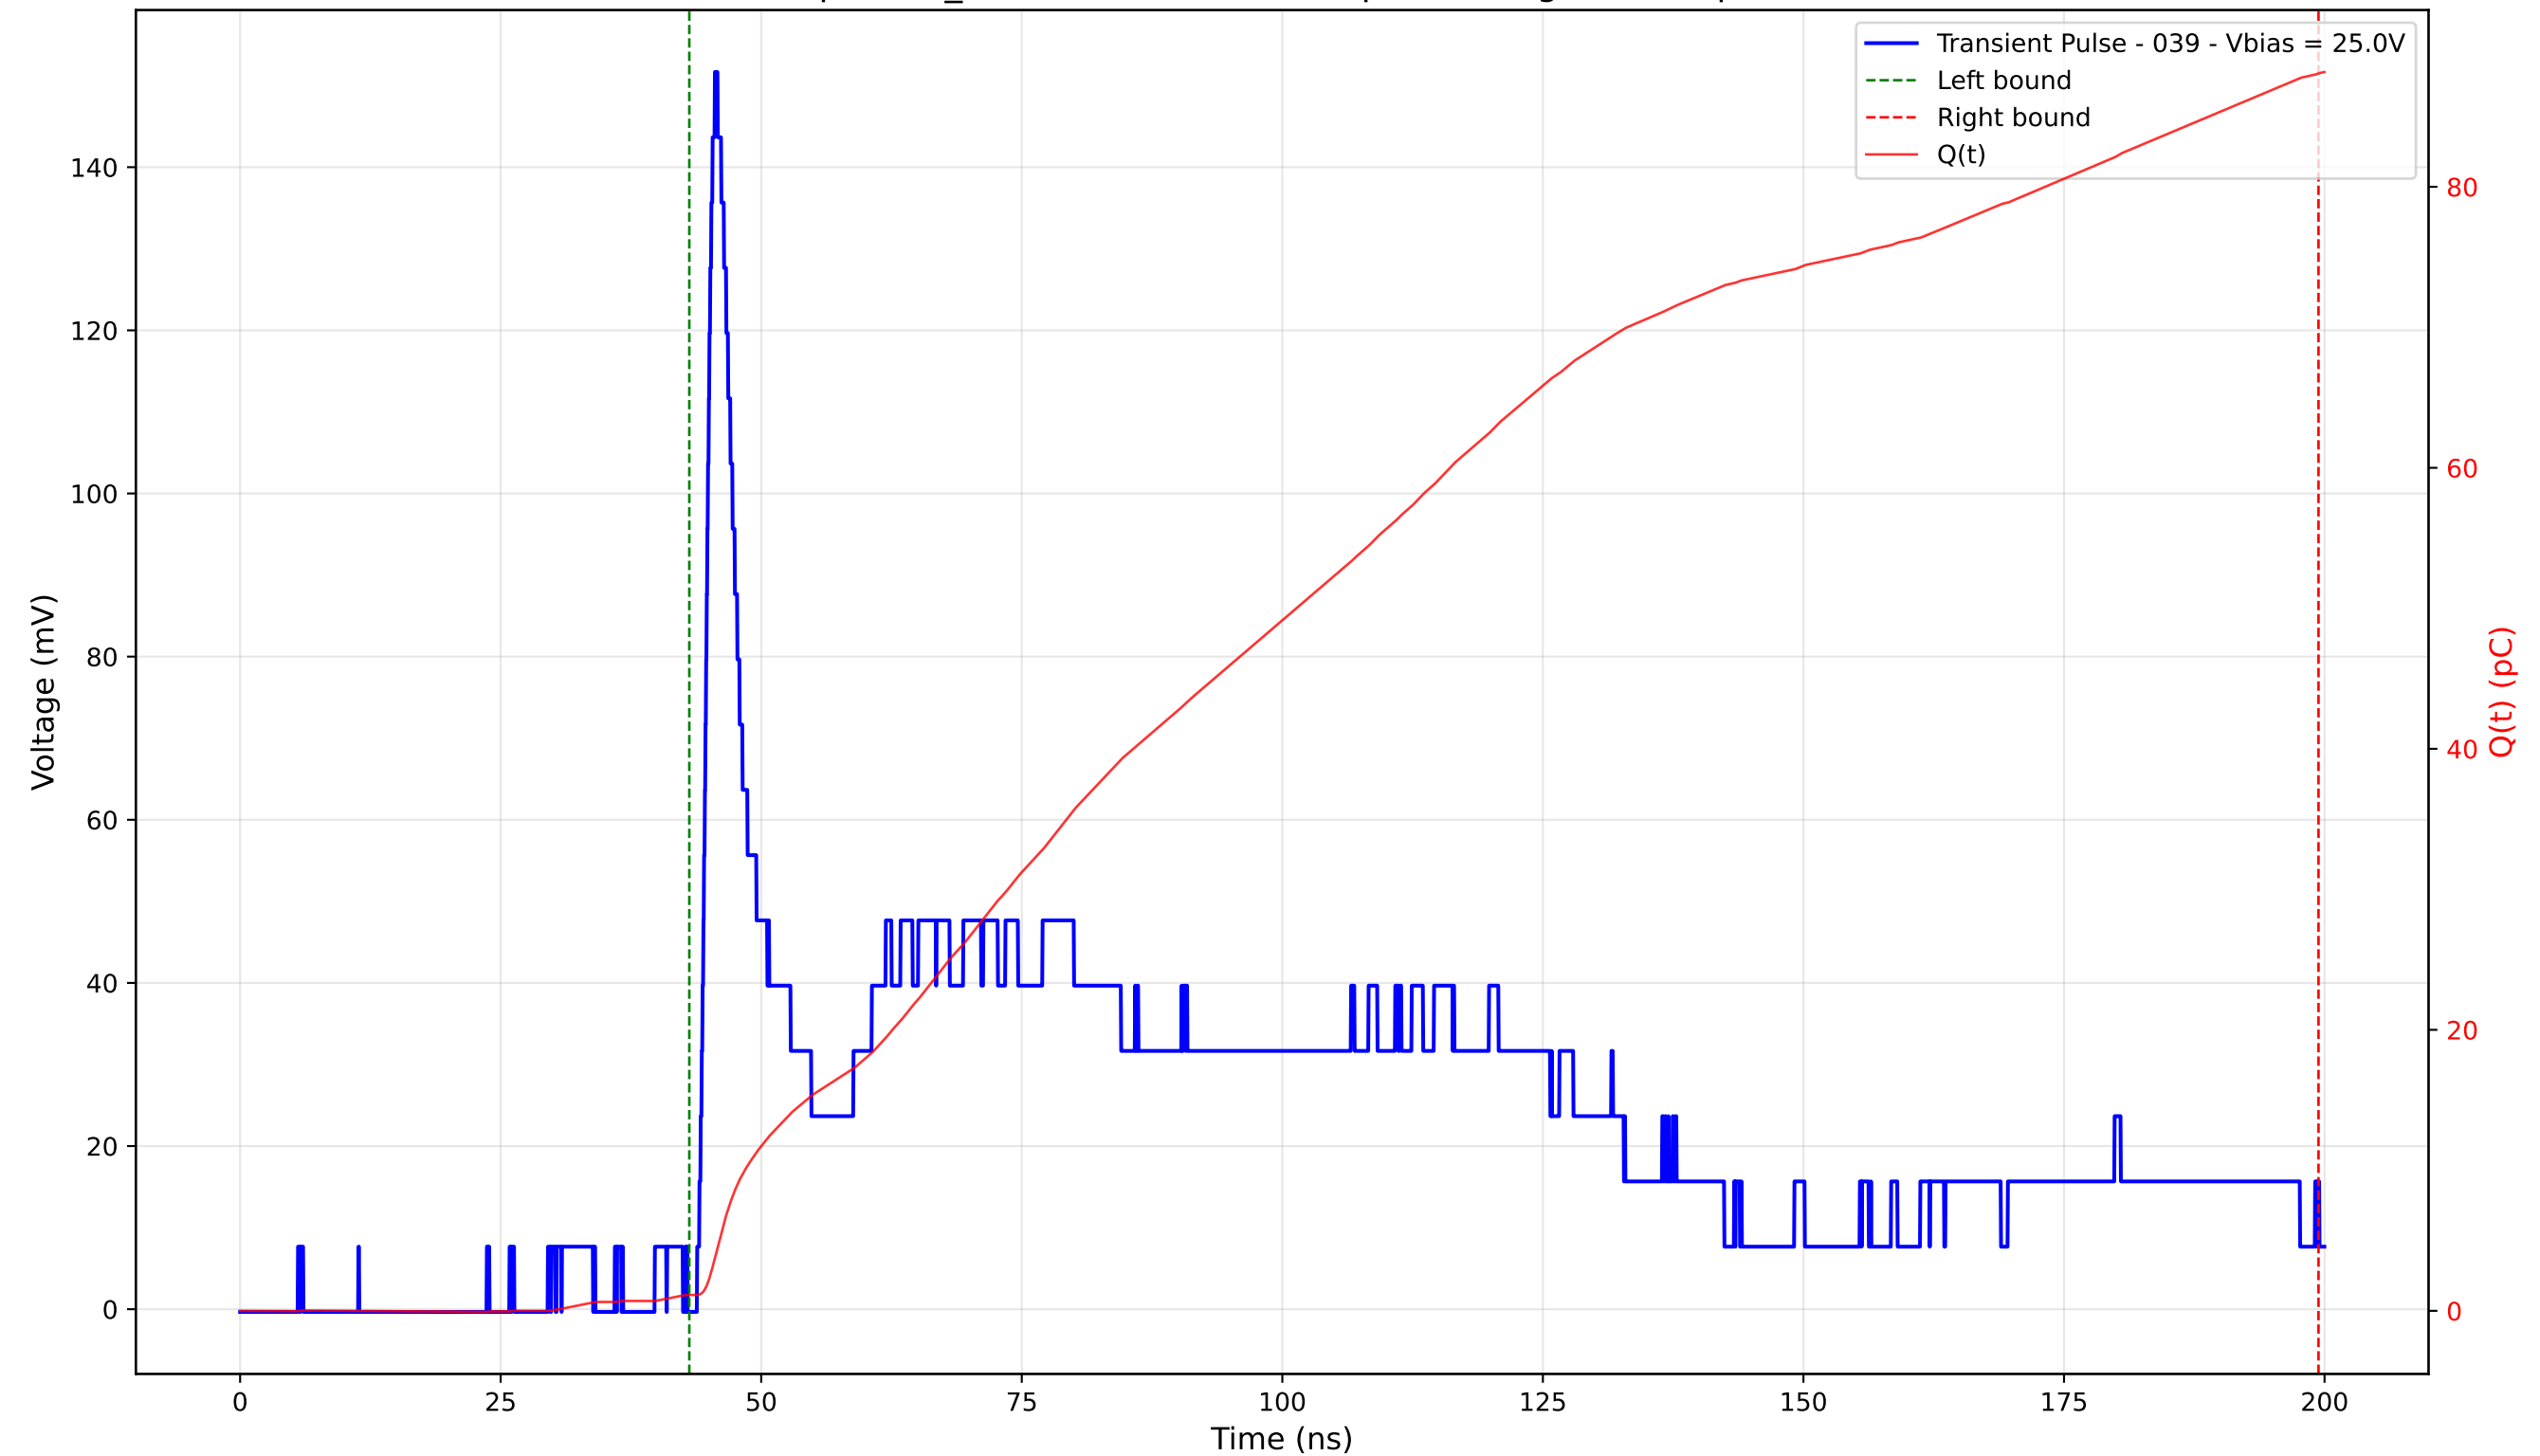


Transient Pulse - Sample: TD_4004 - Position: 155.0 μm - Charge: 77.55 pC - Rise Time: 1.16 ns

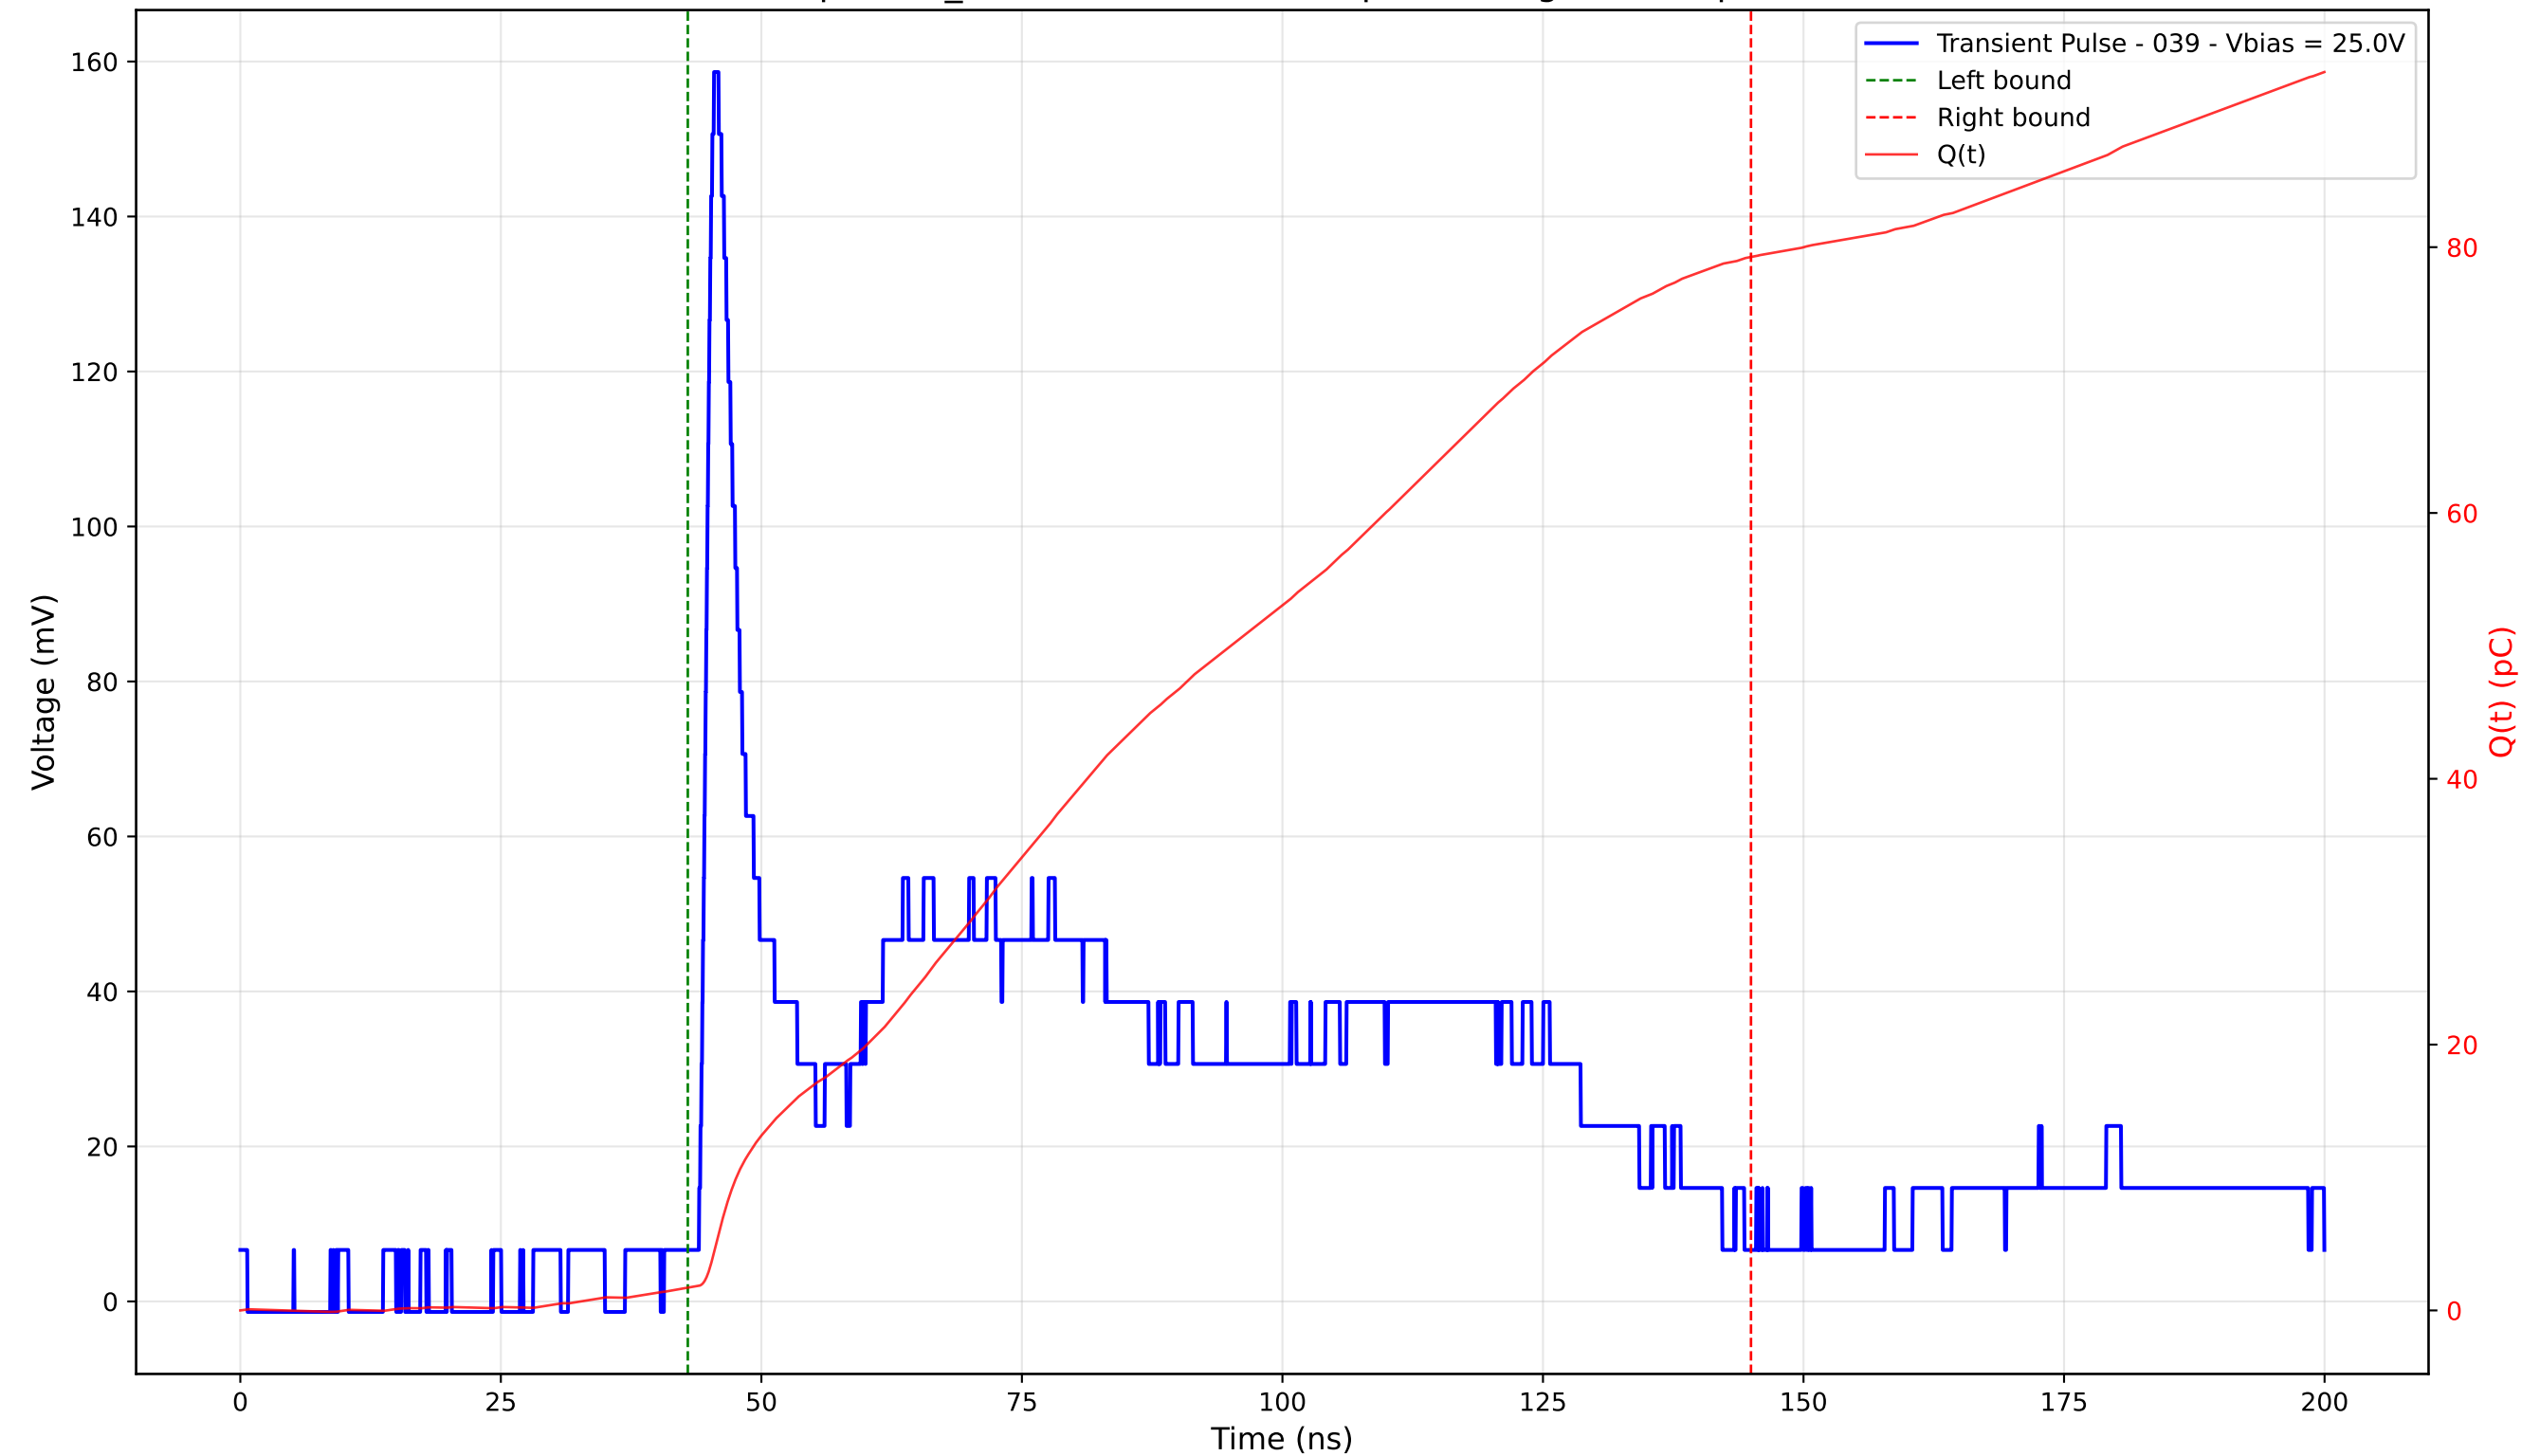


Transient Pulse - Sample: TD_4004 - Position: 160.0 μm - Charge: 75.66 pC - Rise Time: 1.09 ns

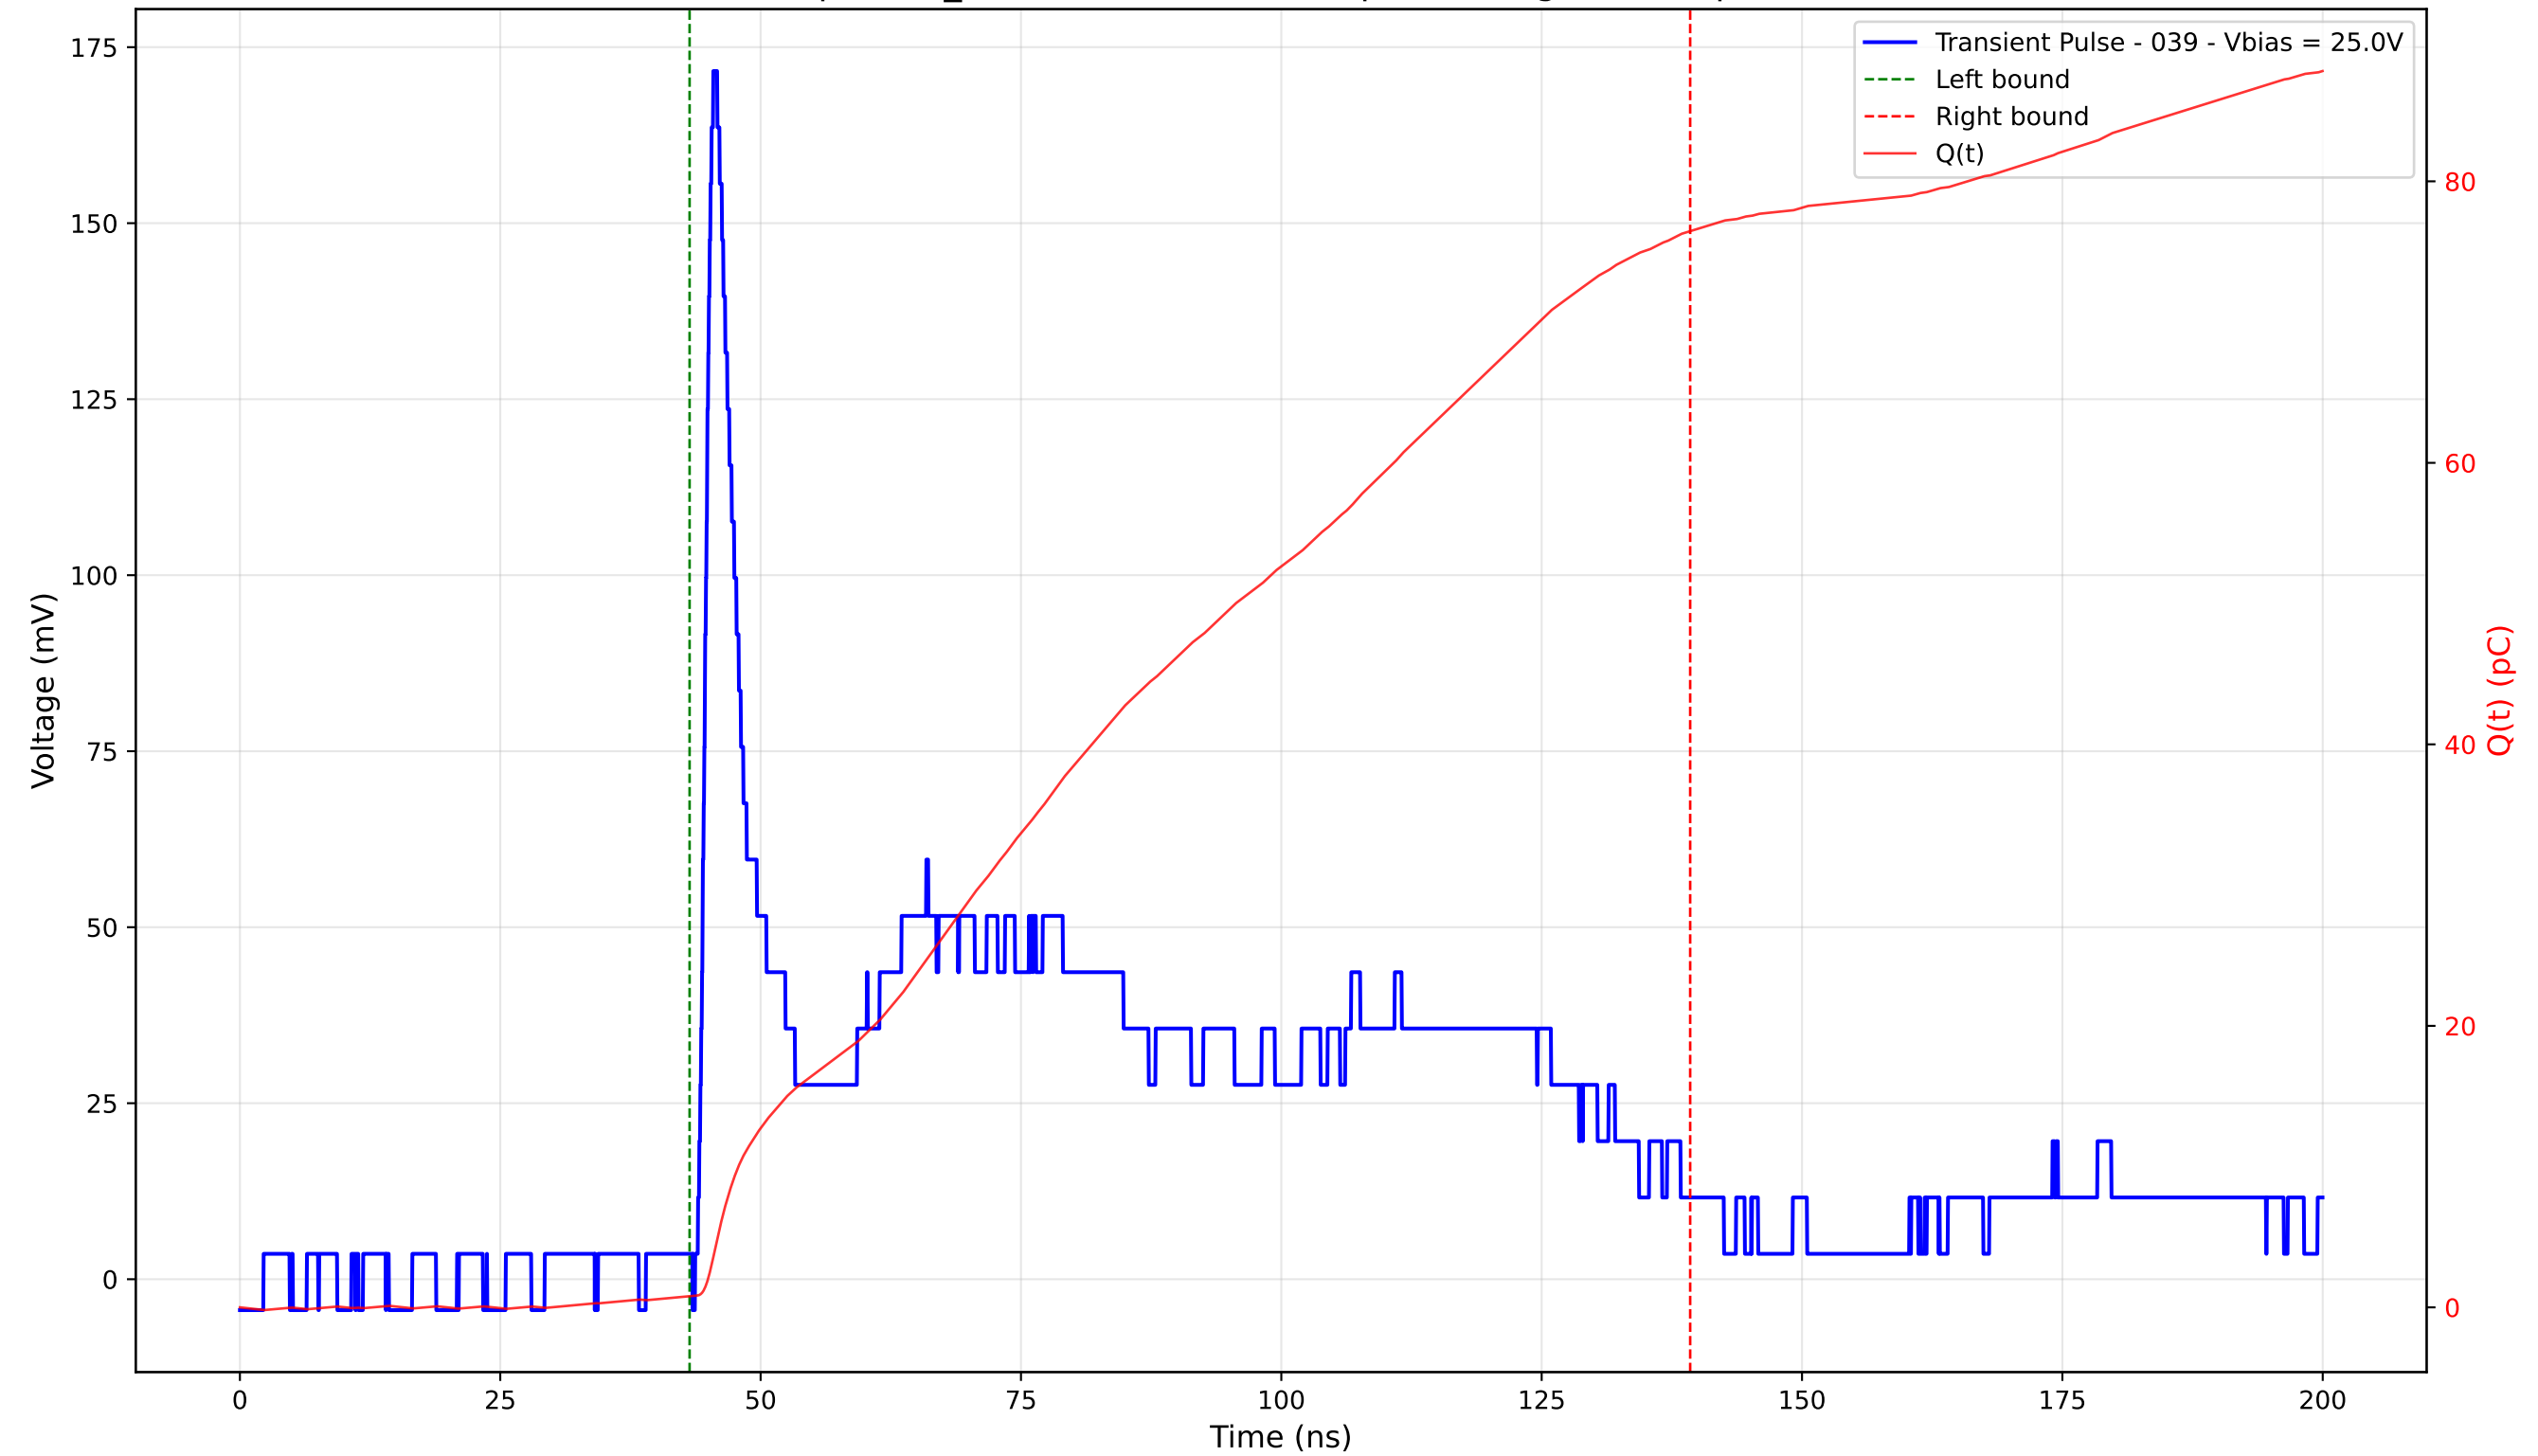


Transient Pulse - Sample: TD_4004 - Position: 165.0 μm - Charge: 80.36 pC - Rise Time: 1.05 ns

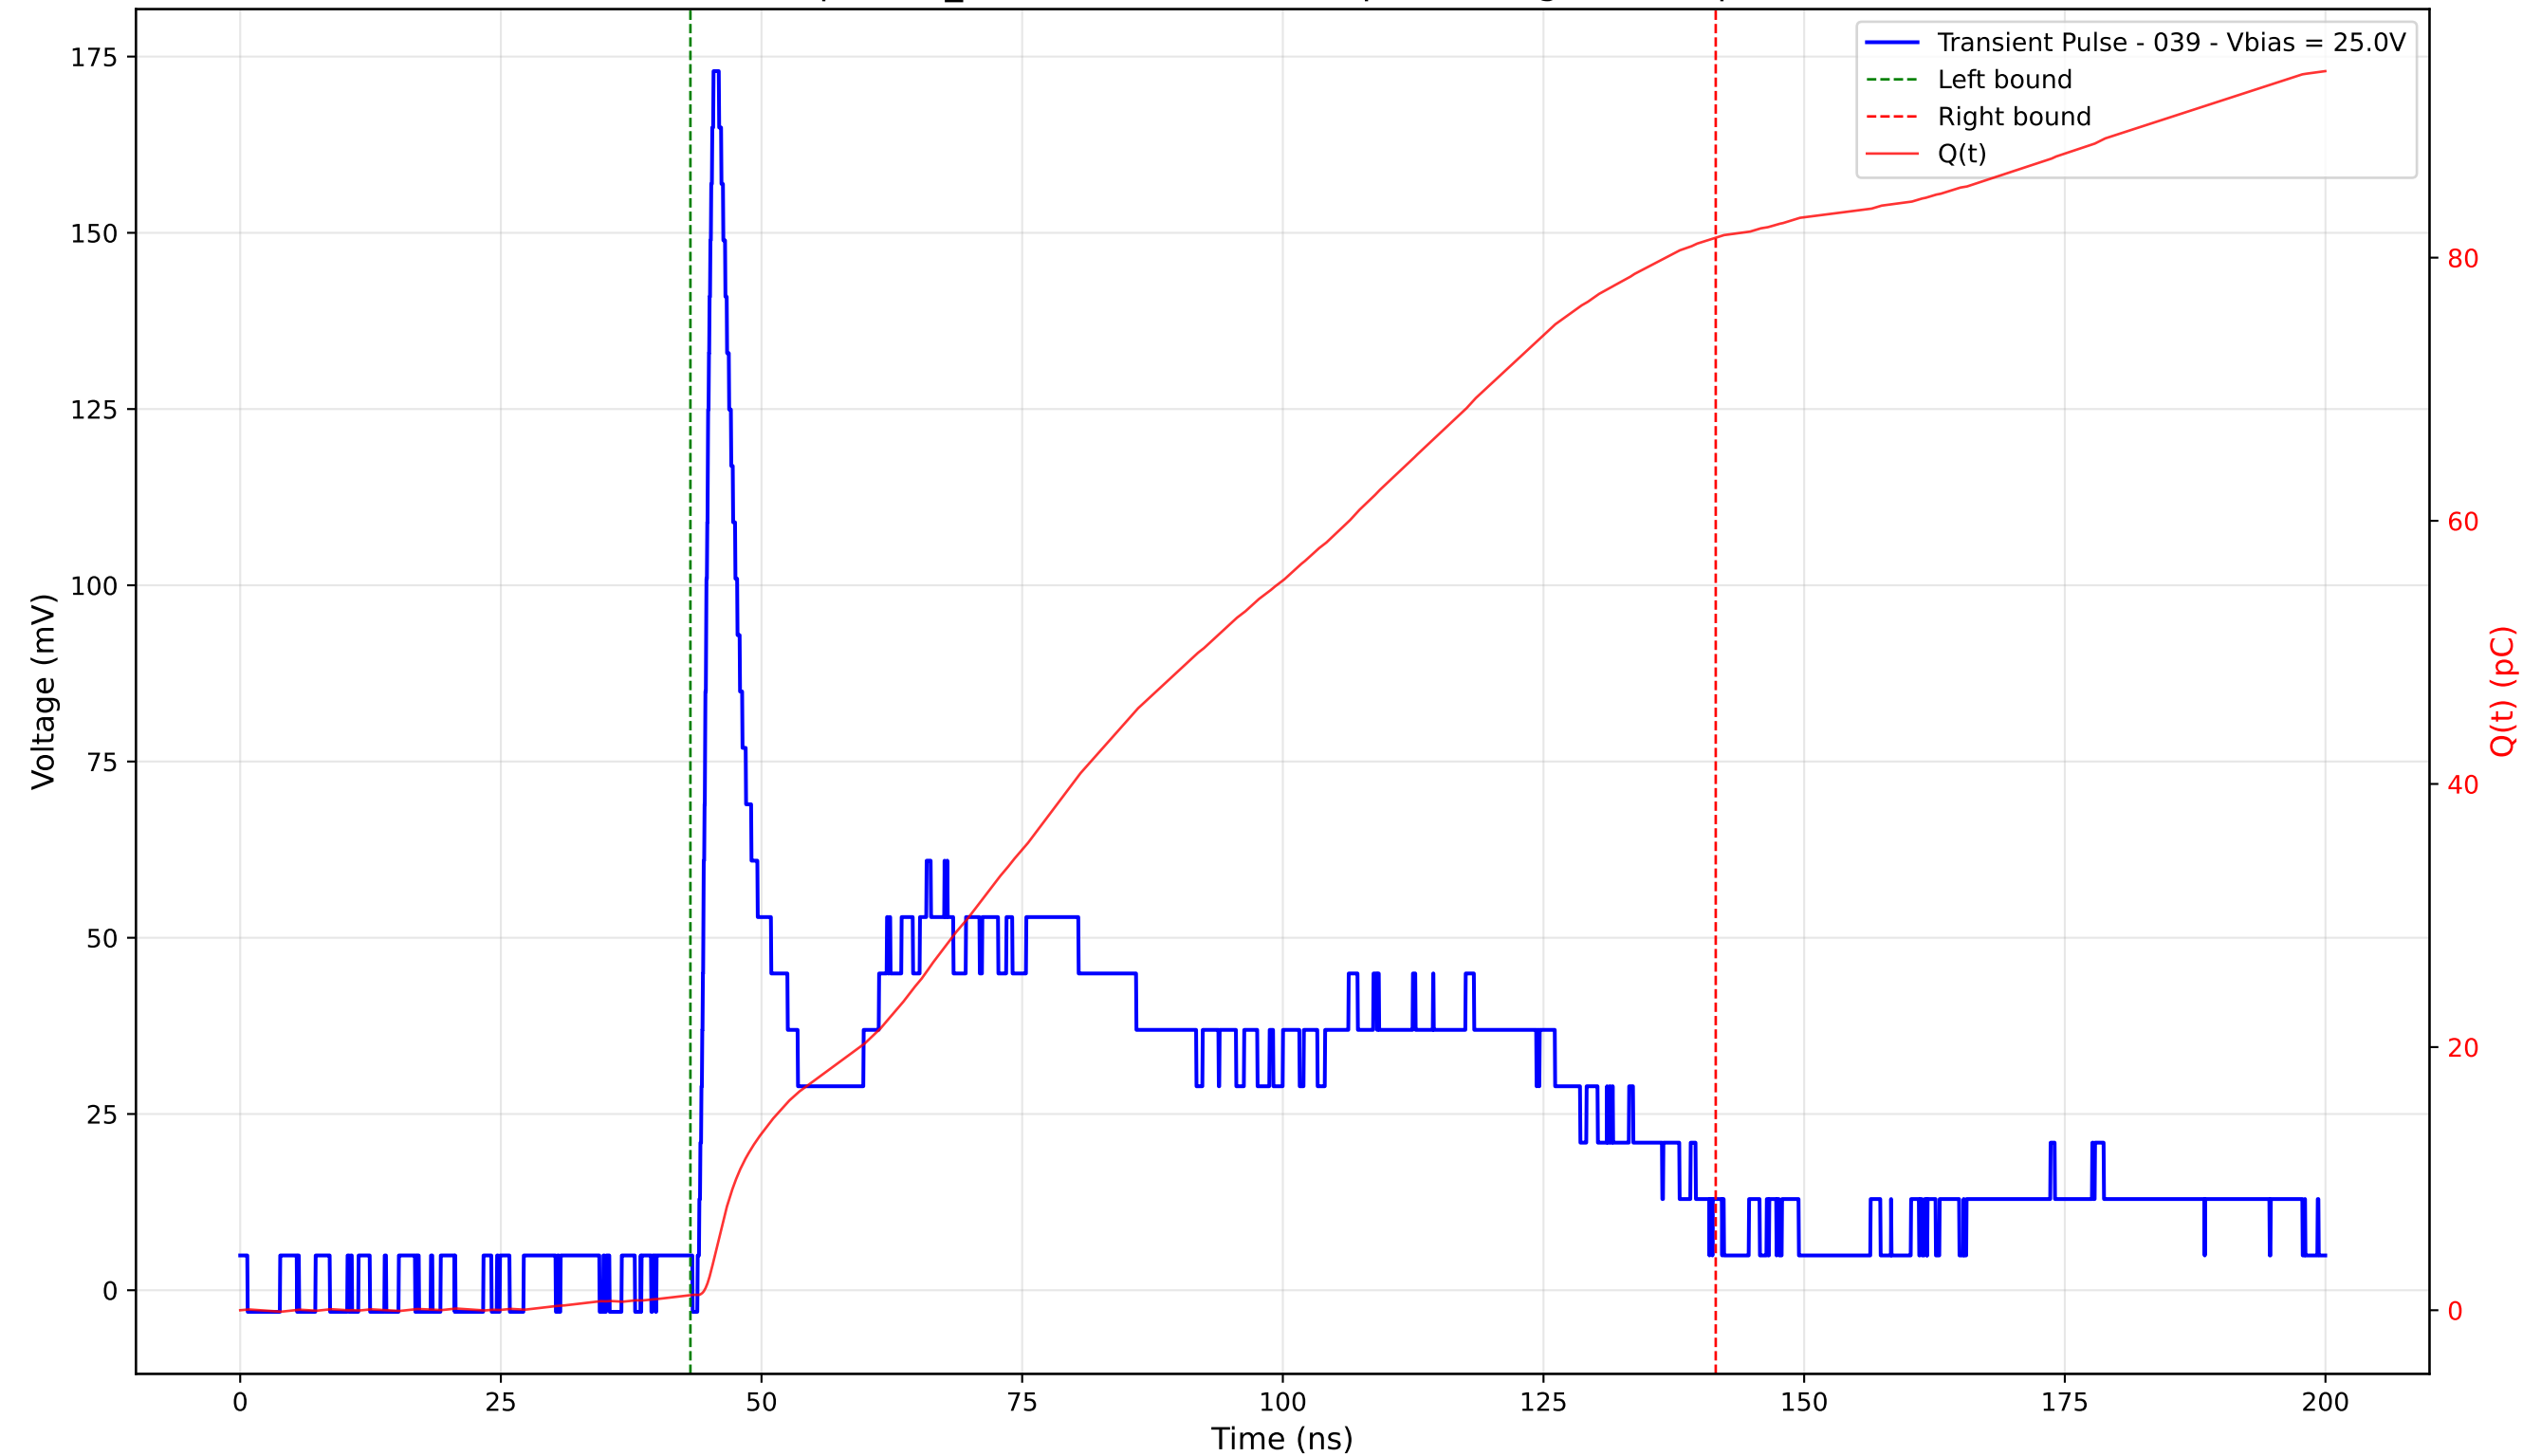


Transient Pulse - Sample: TD_4004 - Position: 170.0 μm - Charge: 83.22 pC - Rise Time: 1.02 ns

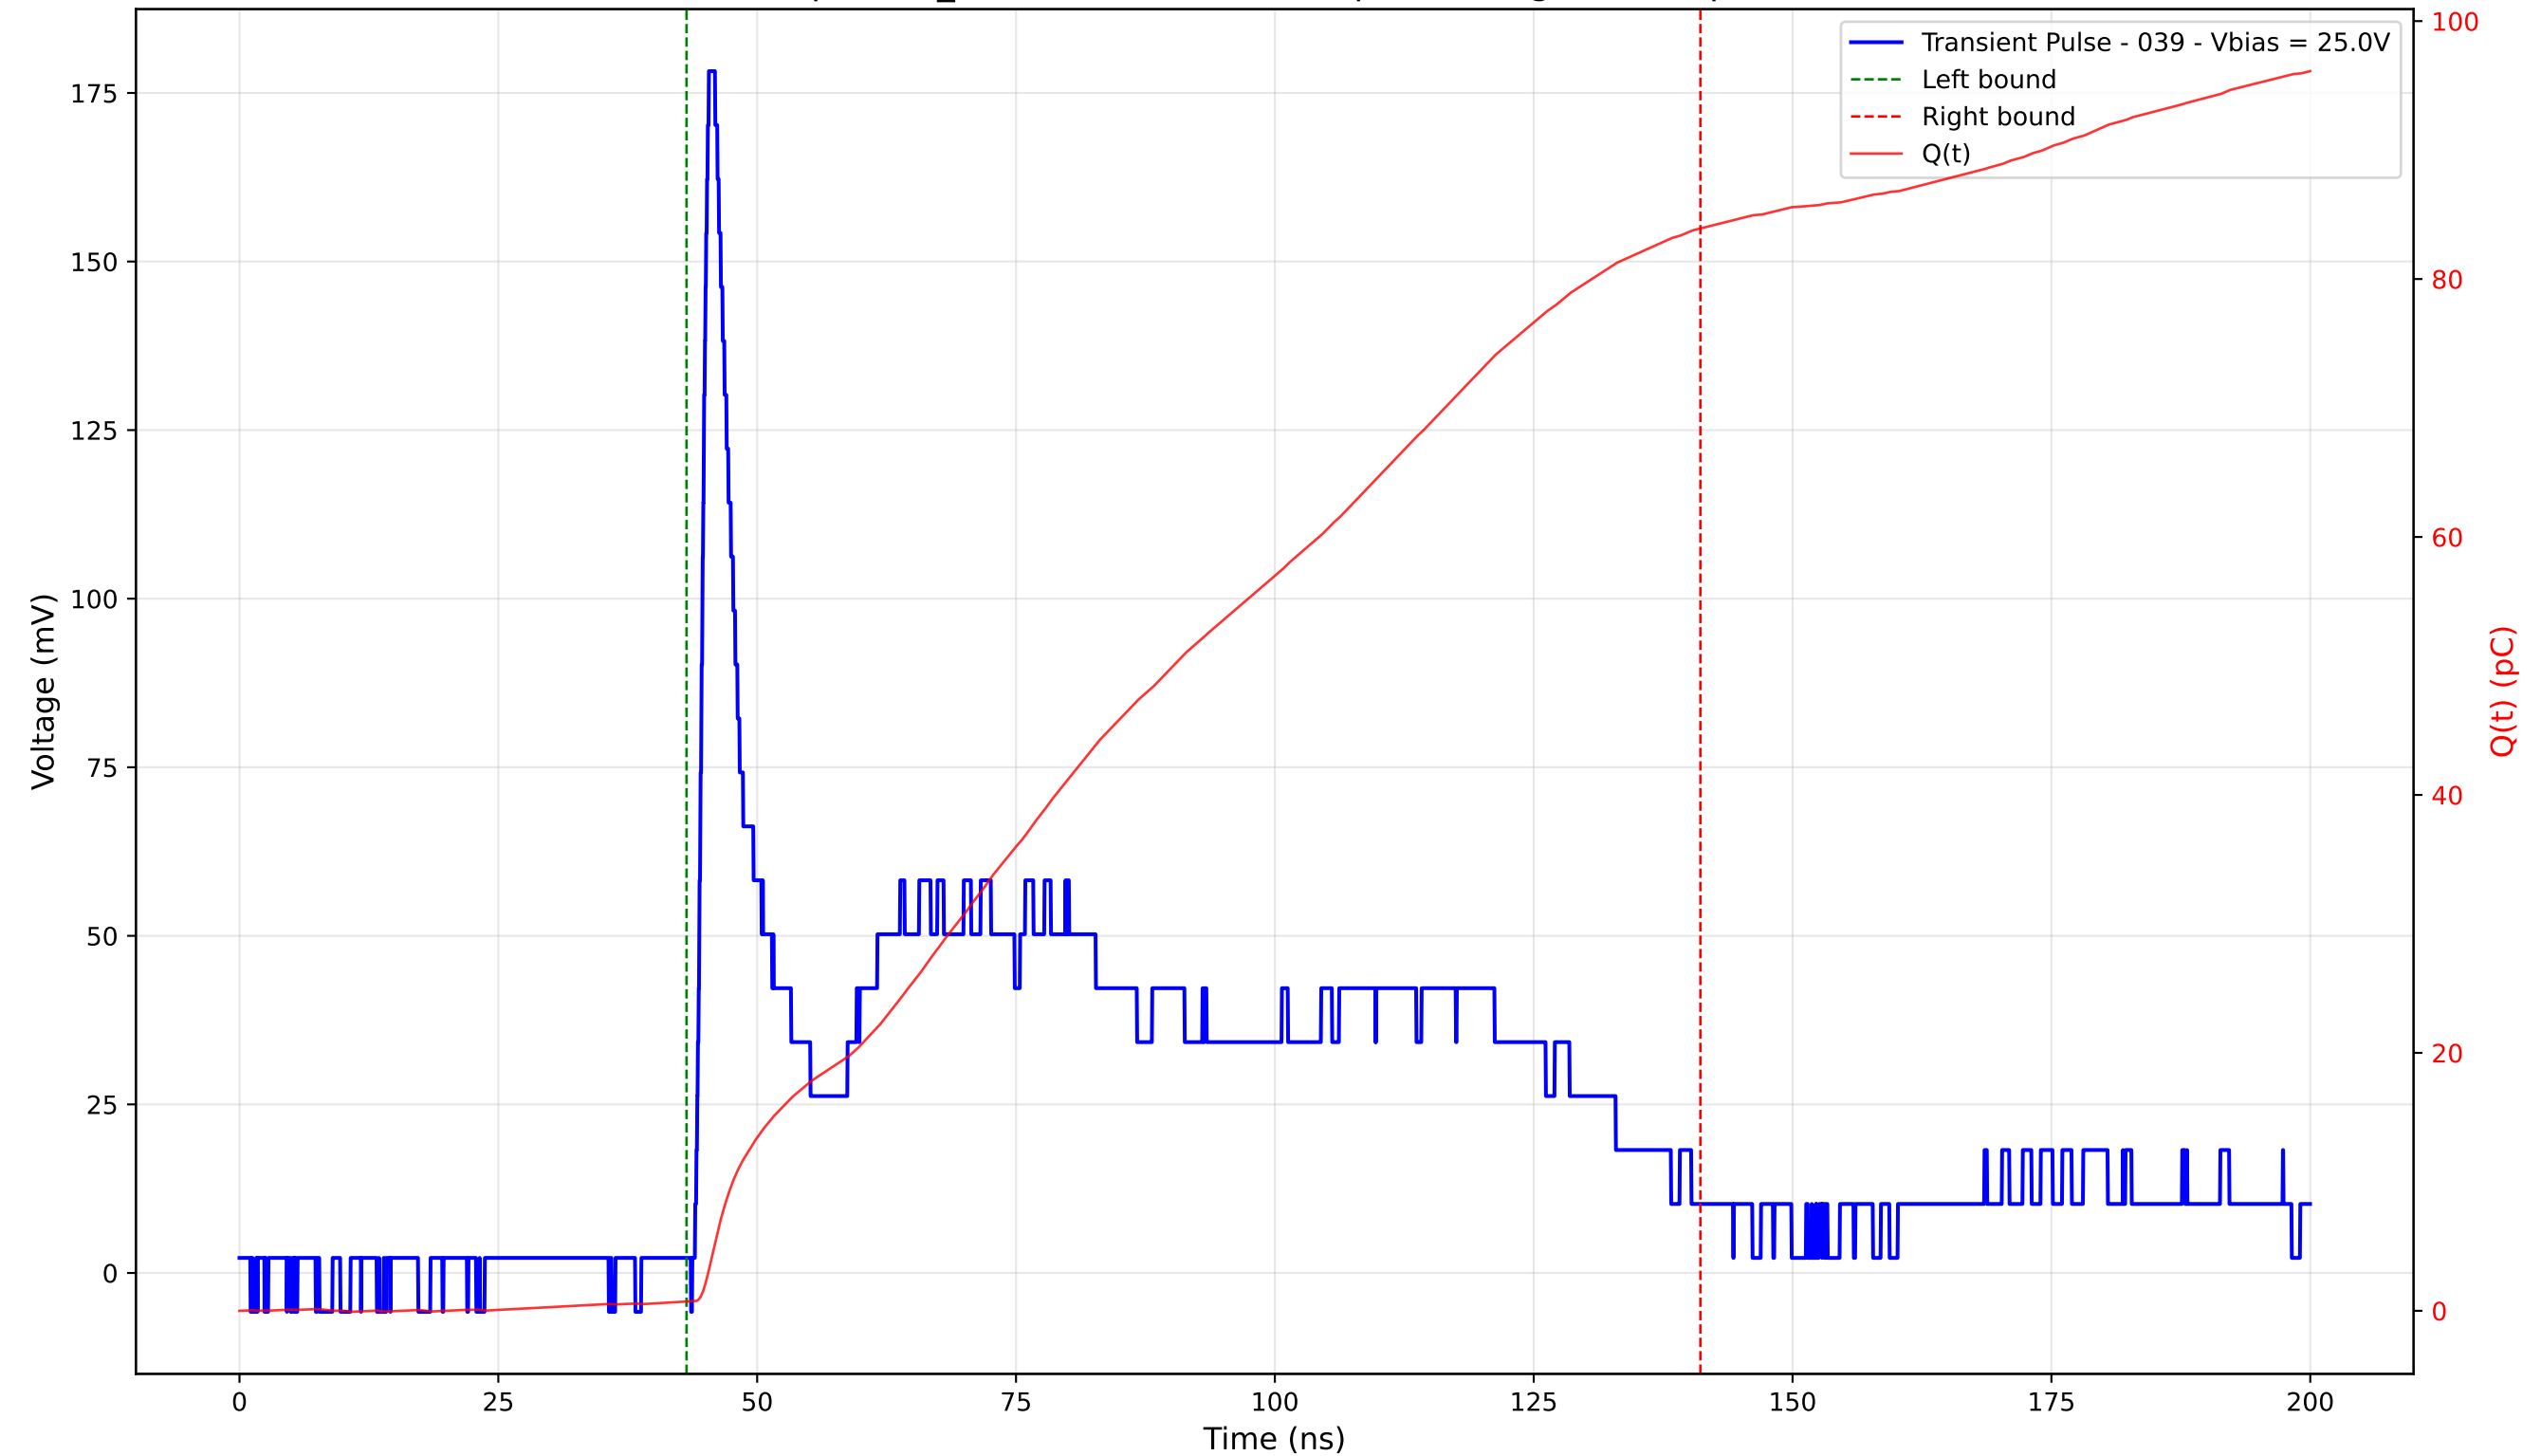


Transient Pulse - Sample: TD_4004 - Position: 175.0 μm - Charge: 99.64 pC - Rise Time: 1.14 ns

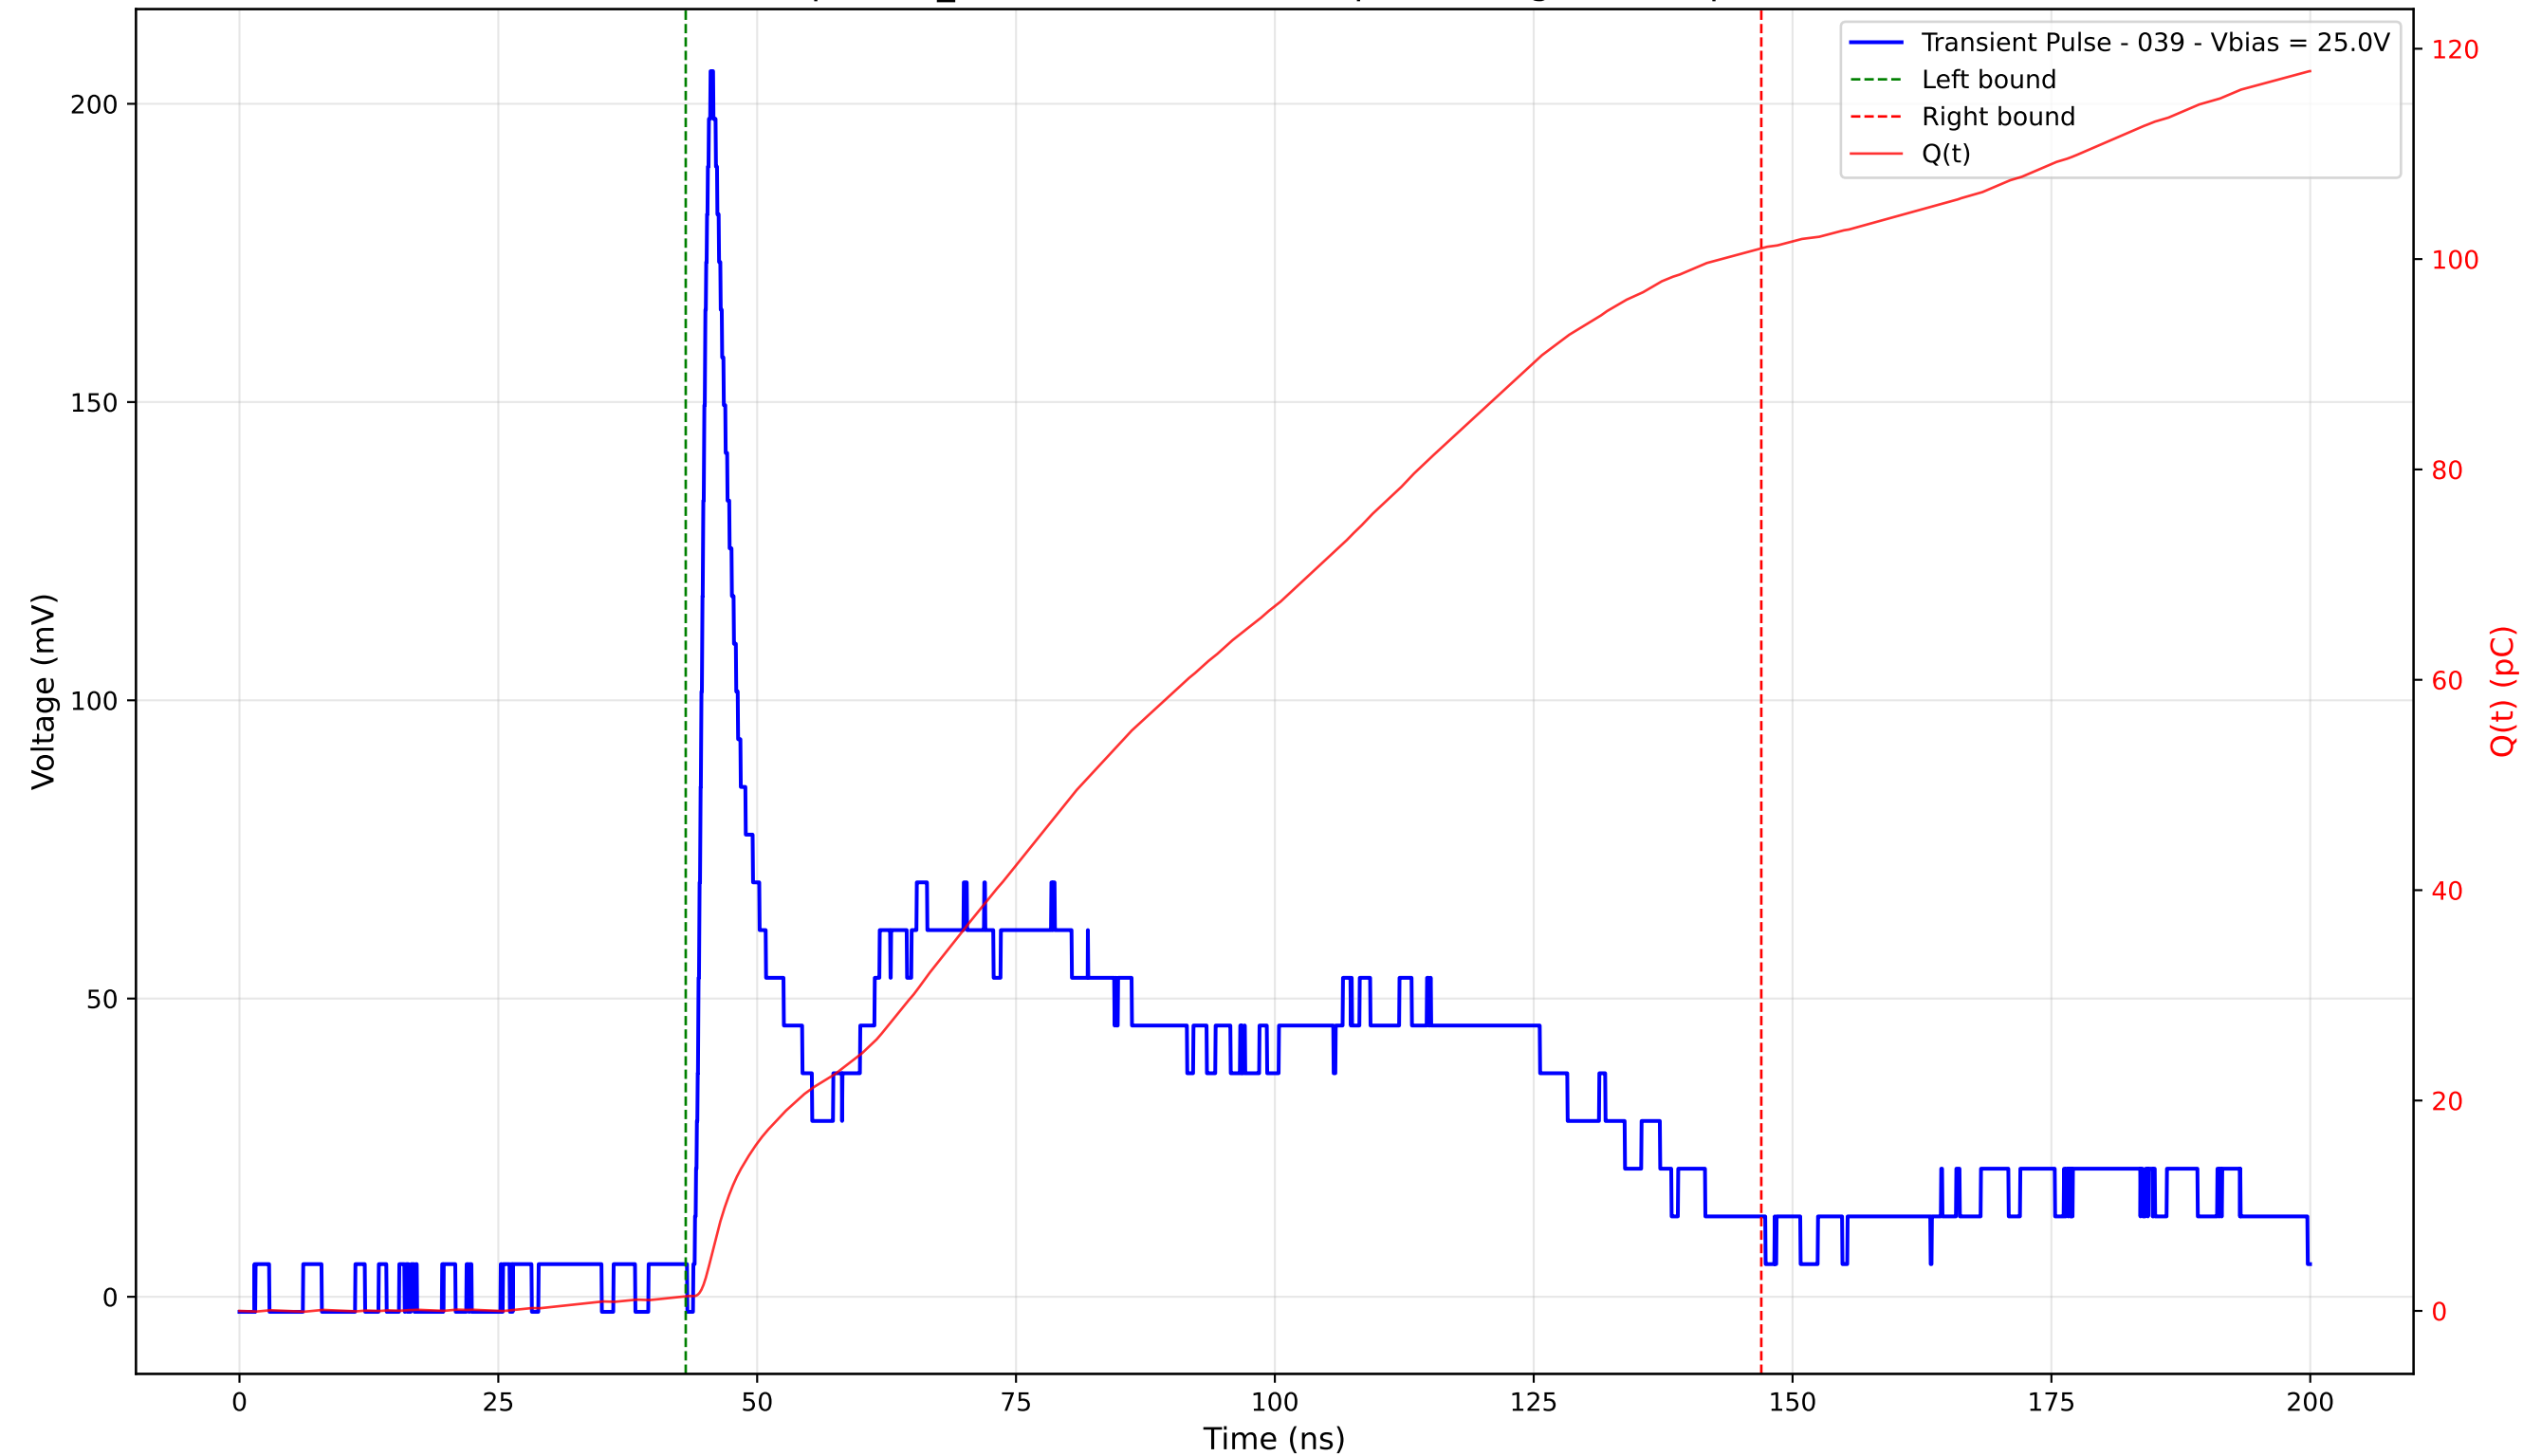


Transient Pulse - Sample: TD_4004 - Position: 180.0 μm - Charge: 95.92 pC - Rise Time: 1.09 ns

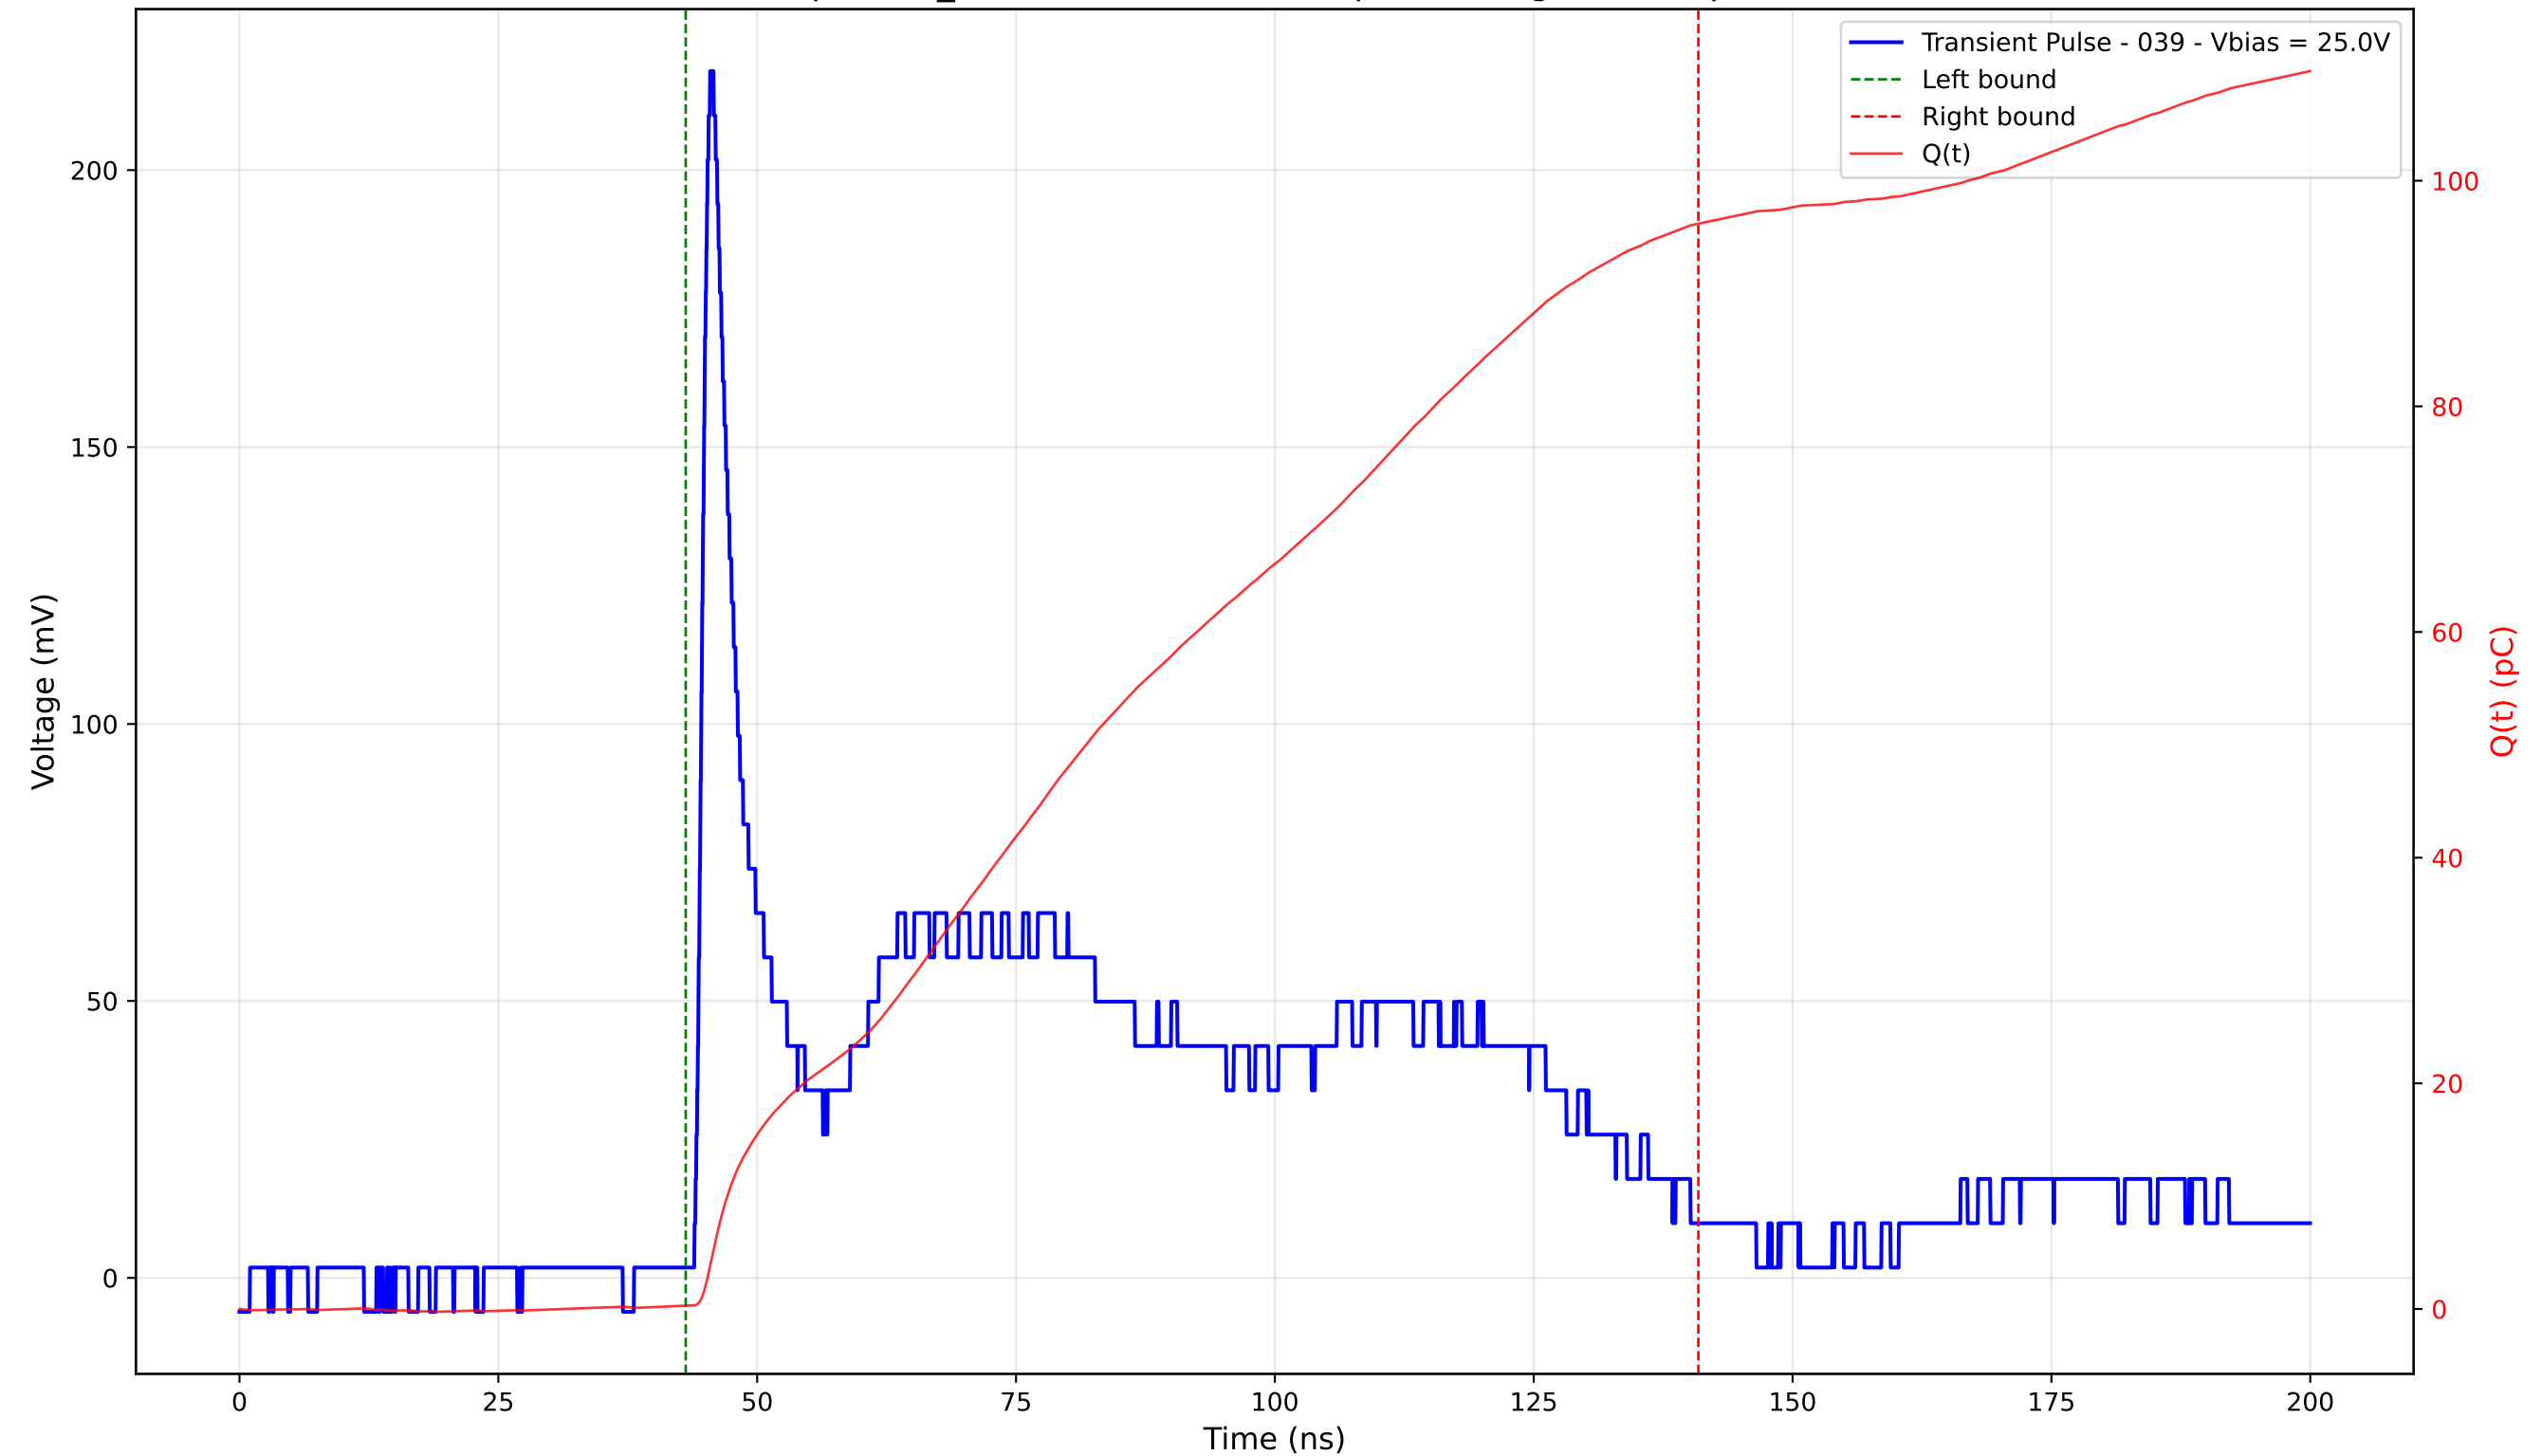


Transient Pulse - Sample: TD_4004 - Position: 185.0 μm - Charge: 110.90 pC - Rise Time: 1.08 ns

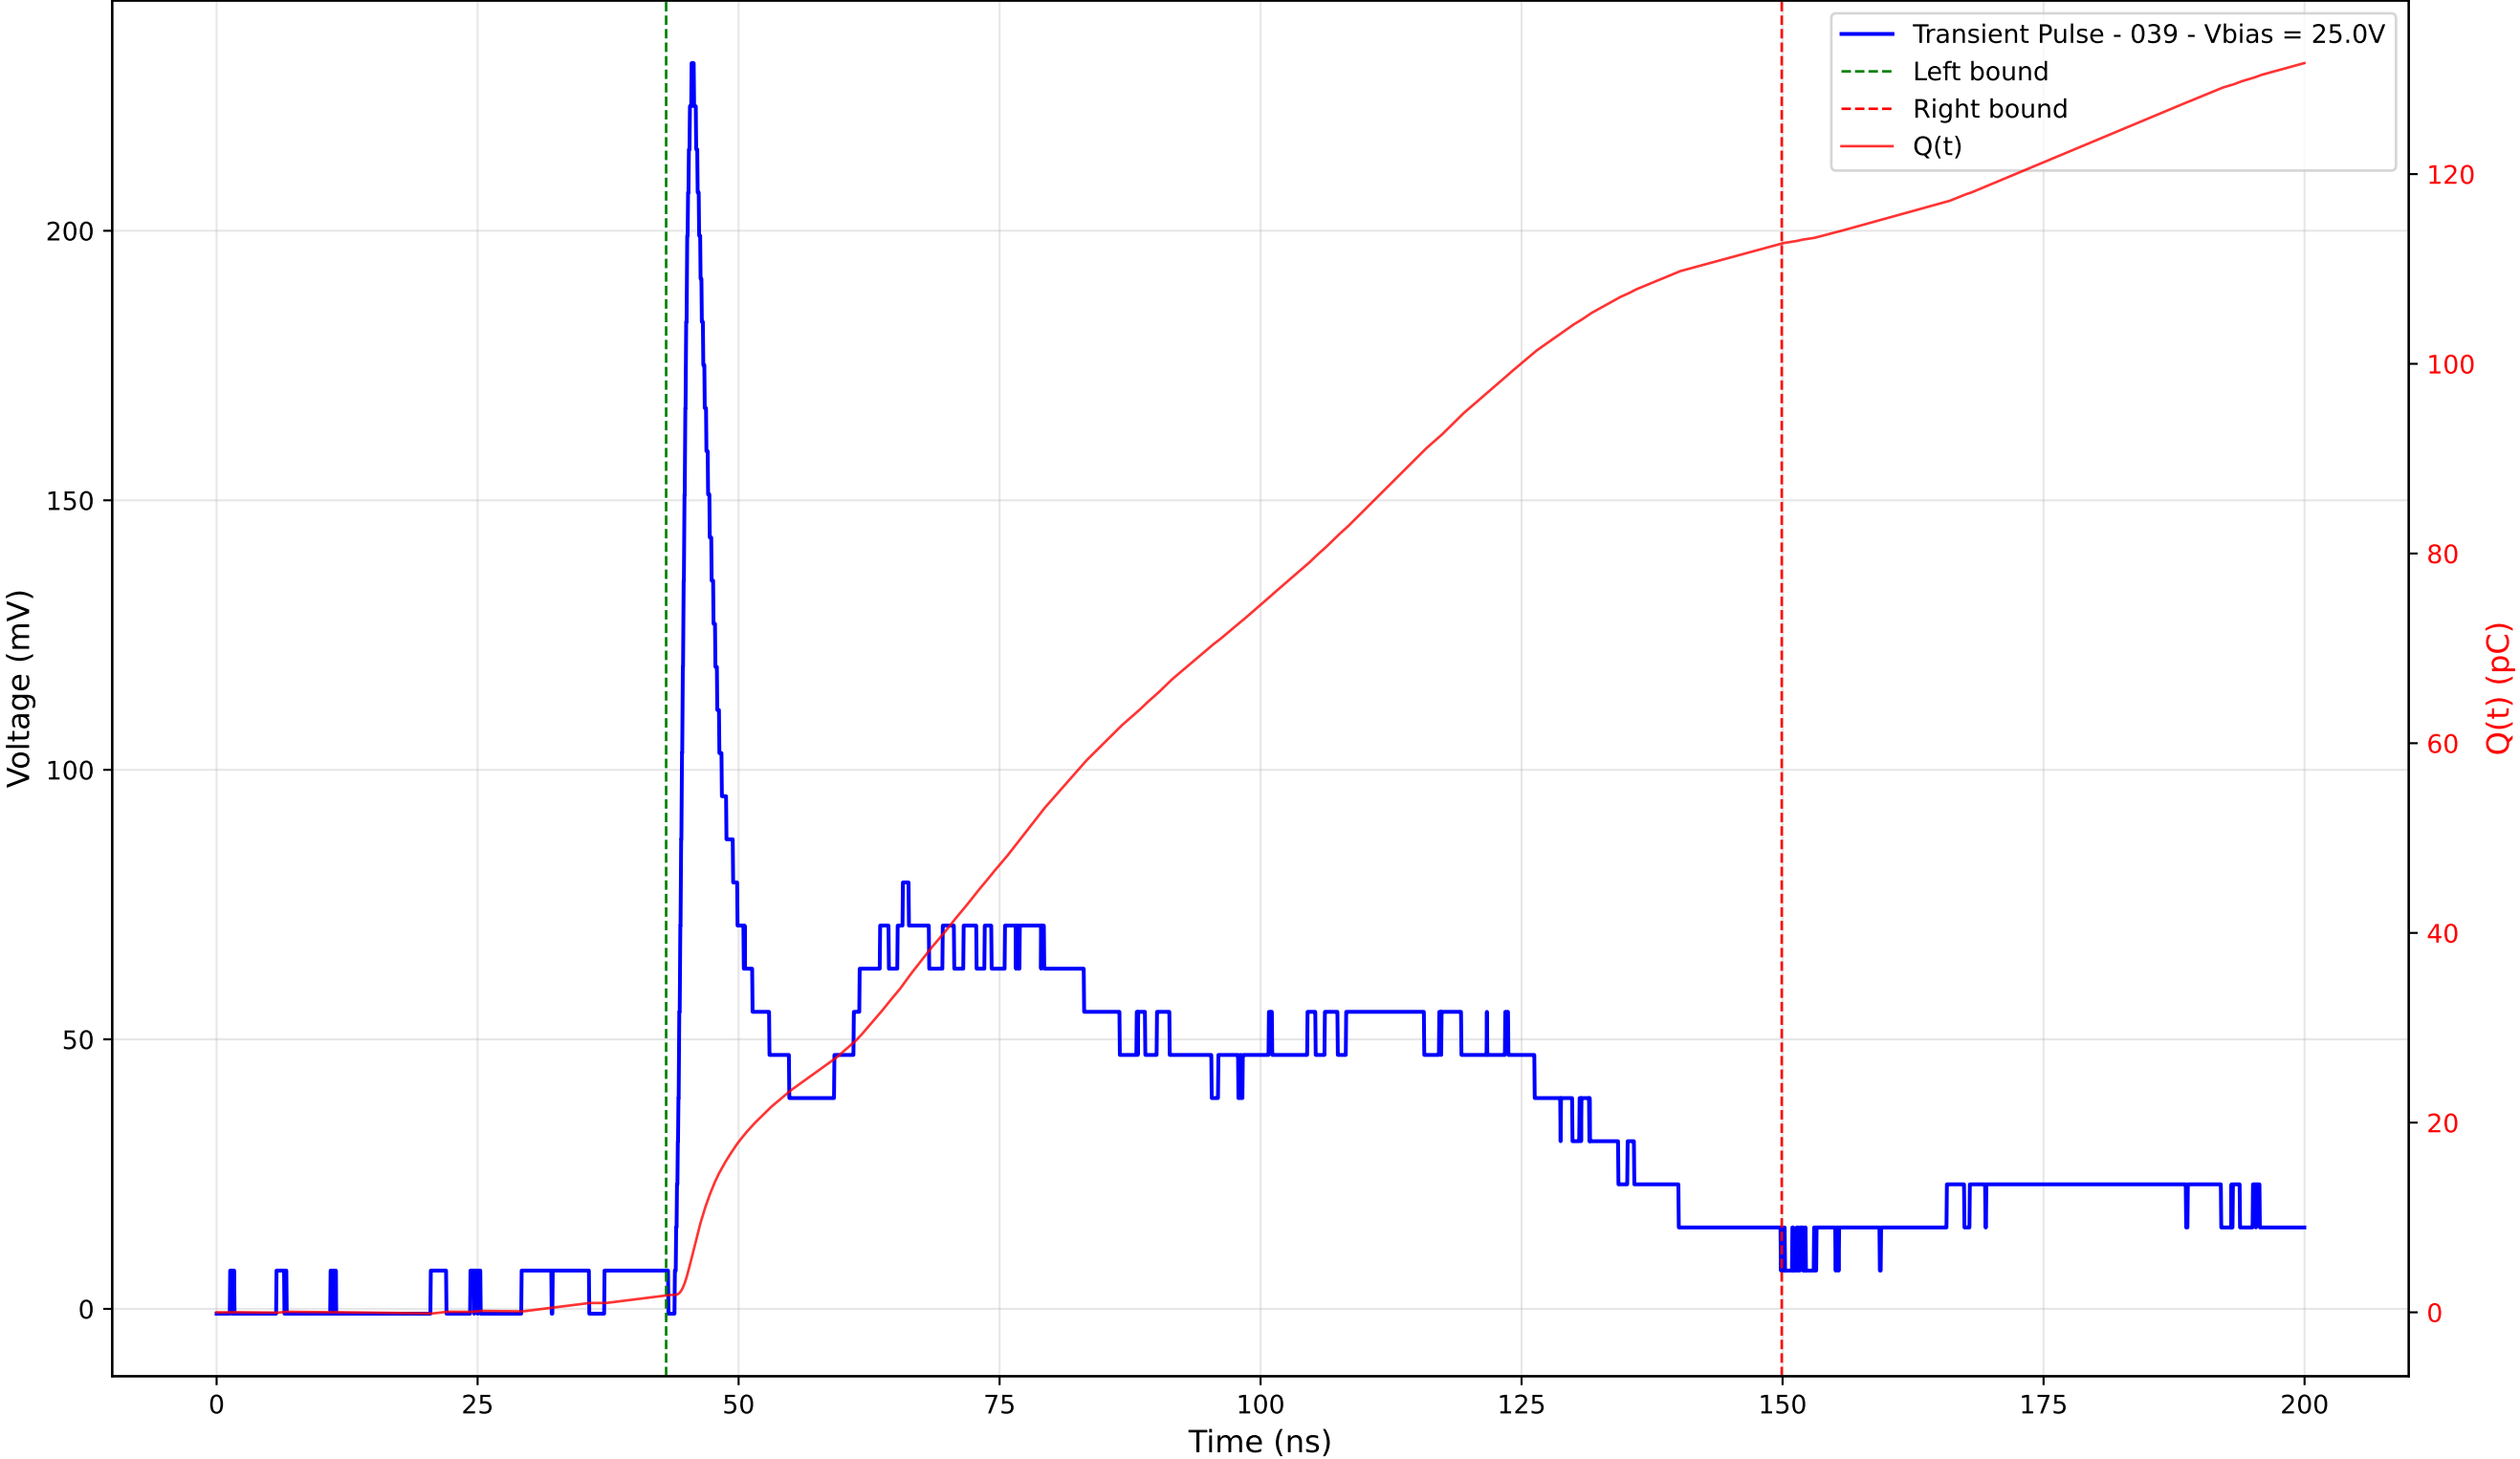


Transient Pulse - Sample: TD_4004 - Position: 190.0 μm - Charge: 100.21 pC - Rise Time: 1.13 ns

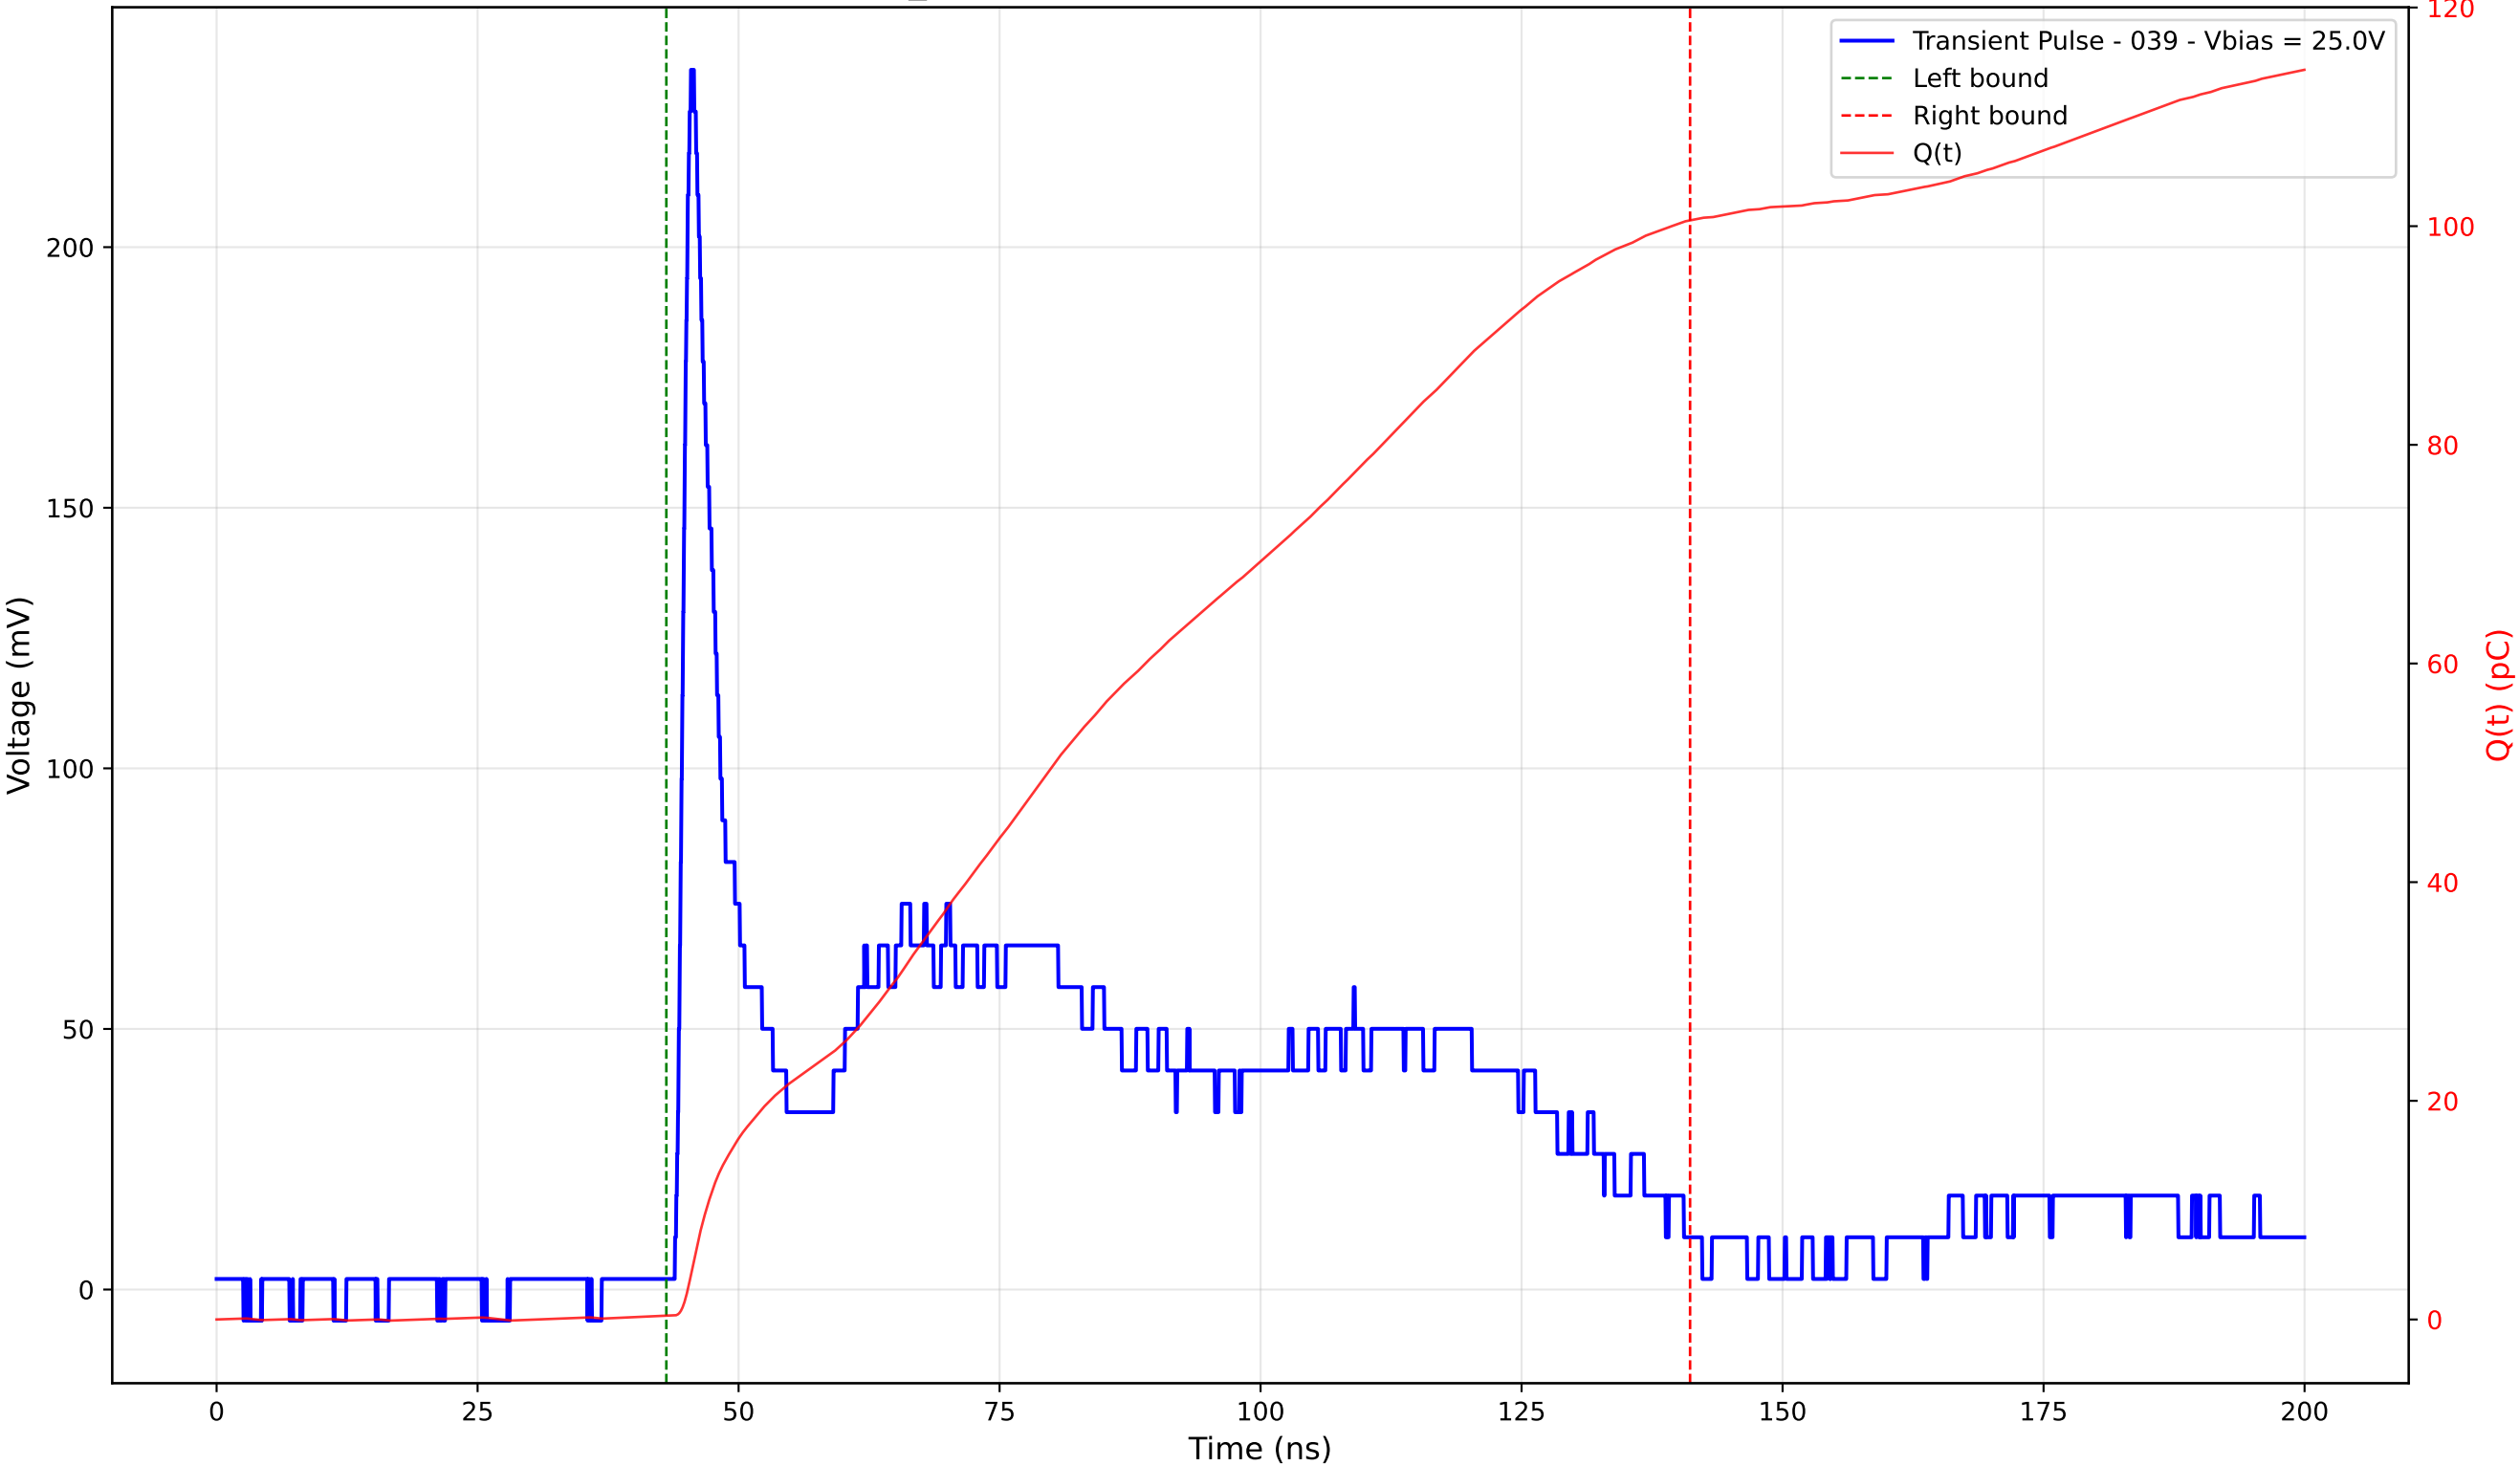


Transient Pulse - Sample: TD_4004 - Position: 195.0 μm - Charge: 108.39 pC - Rise Time: 1.03 ns

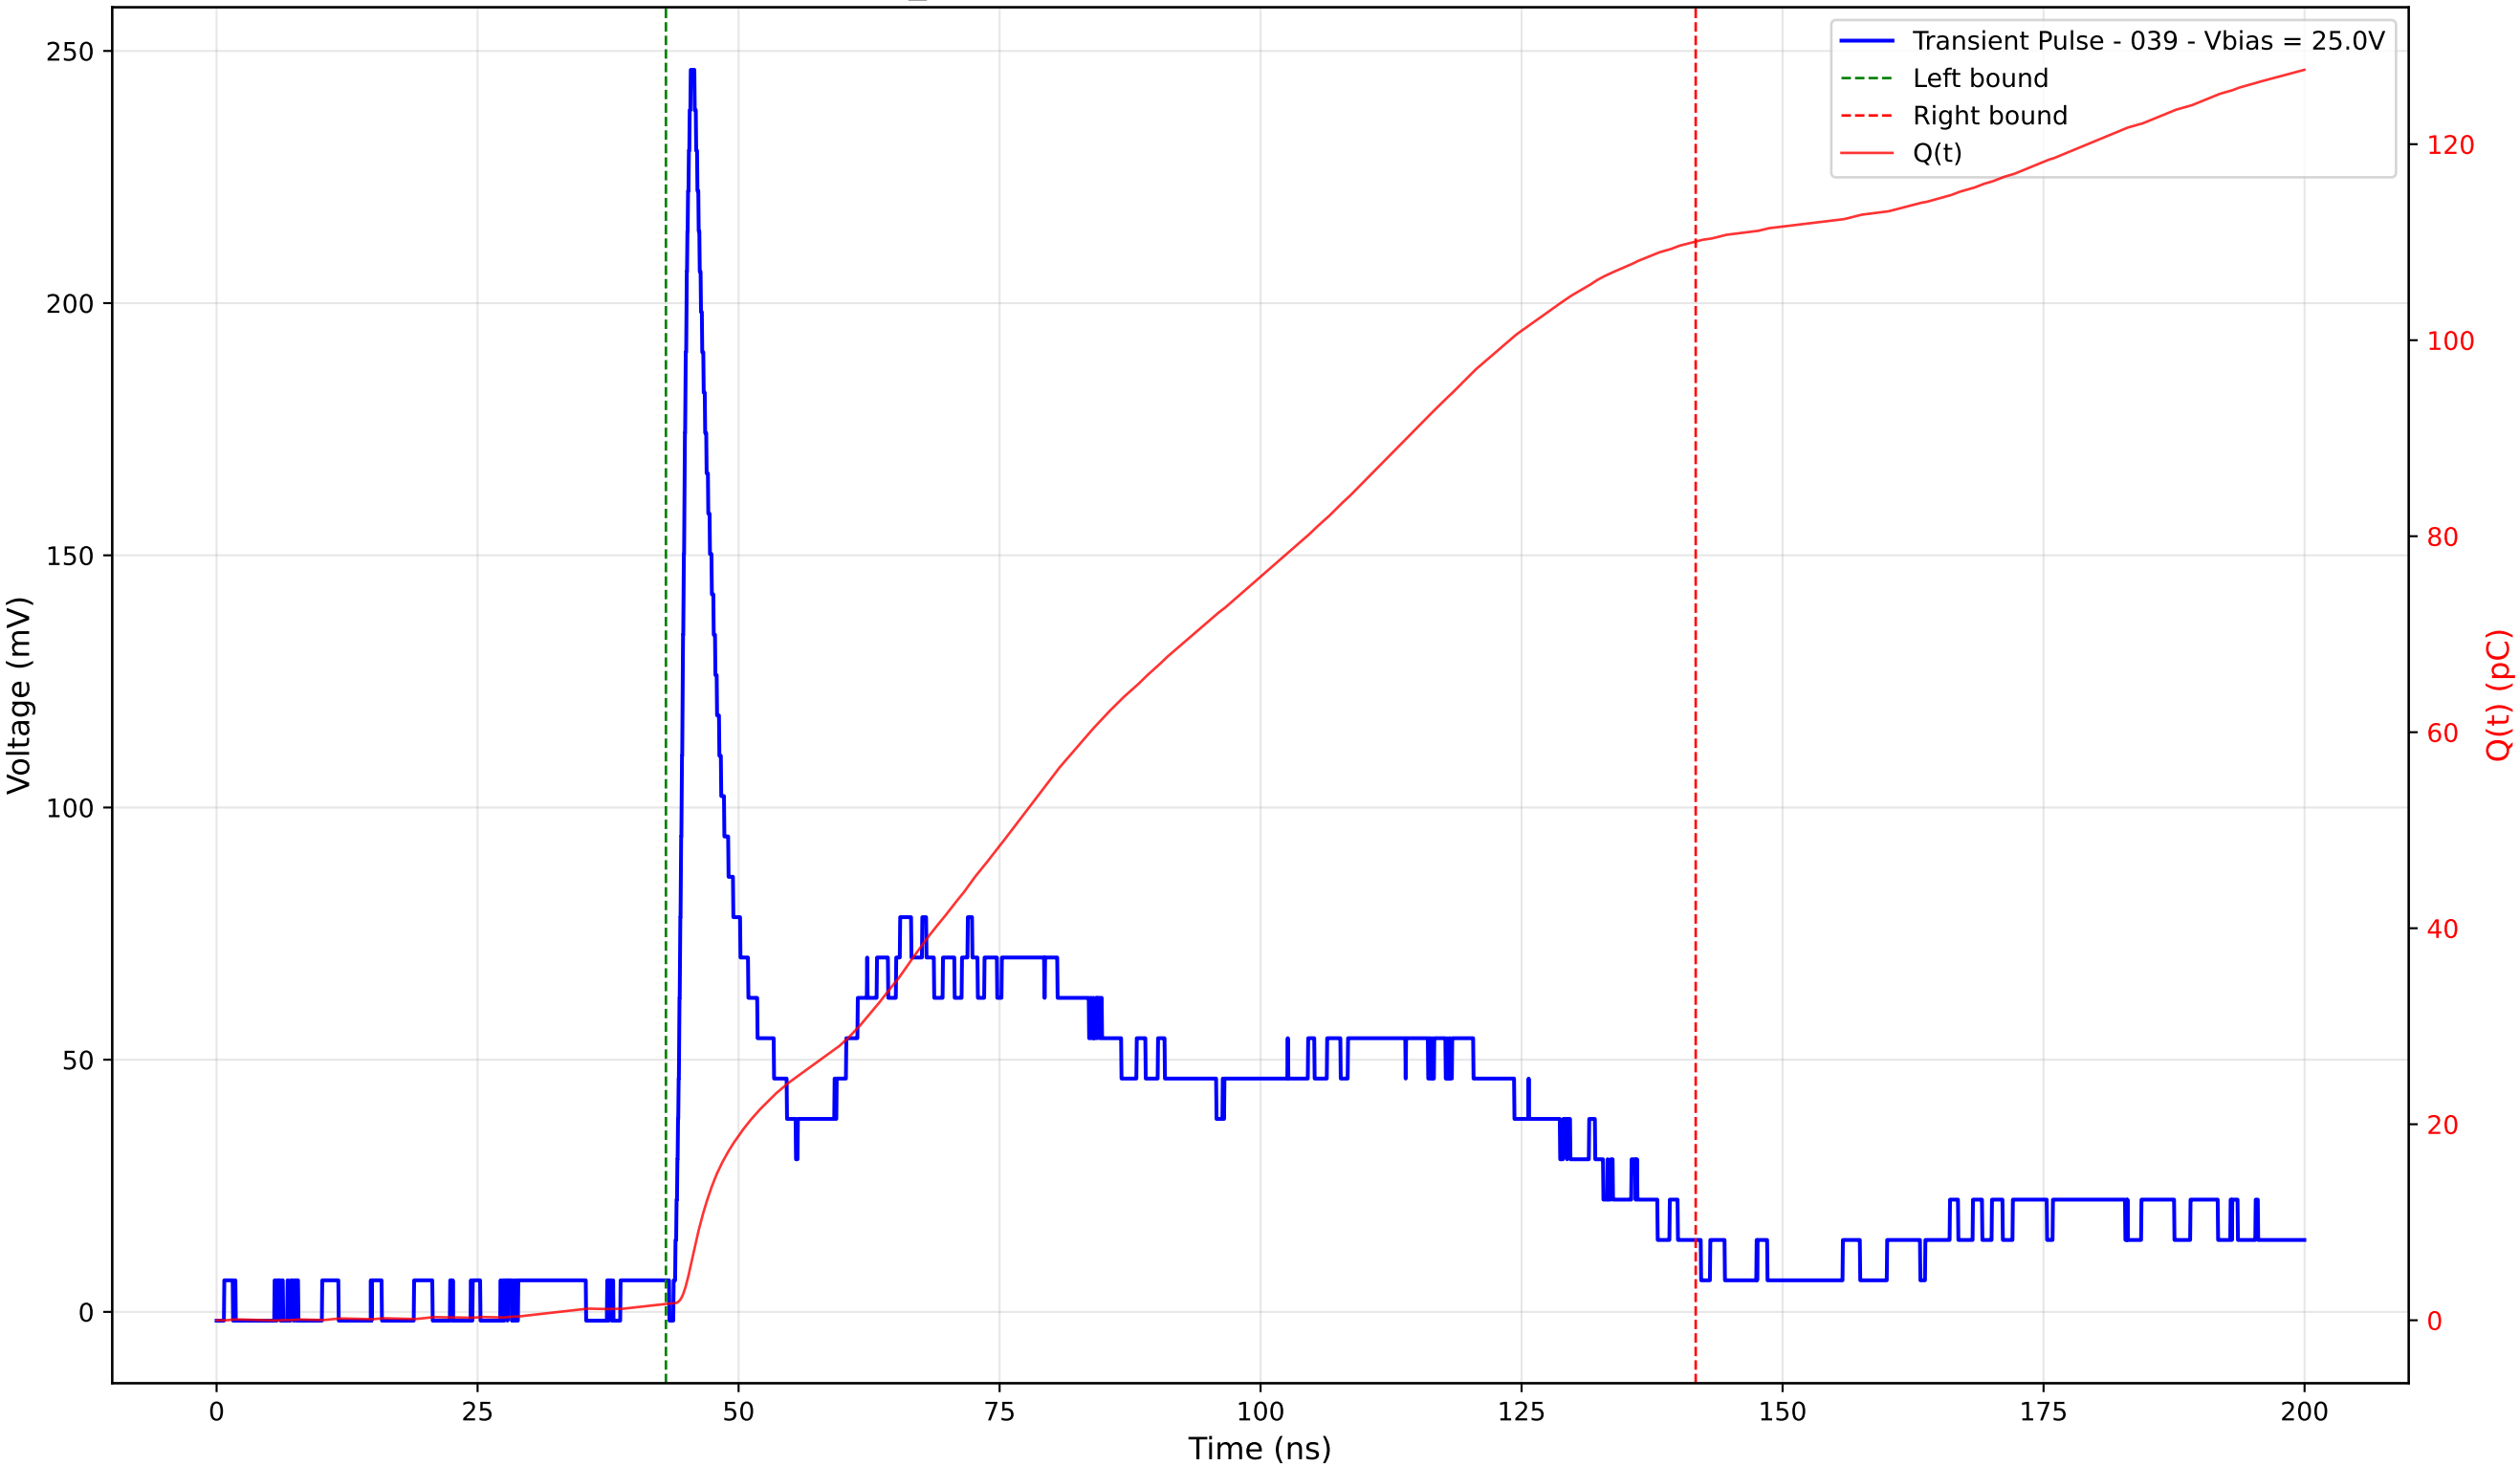


Transient Pulse - Sample: TD_4004 - Position: 200.0 μm - Charge: 96.39 pC - Rise Time: 1.07 ns

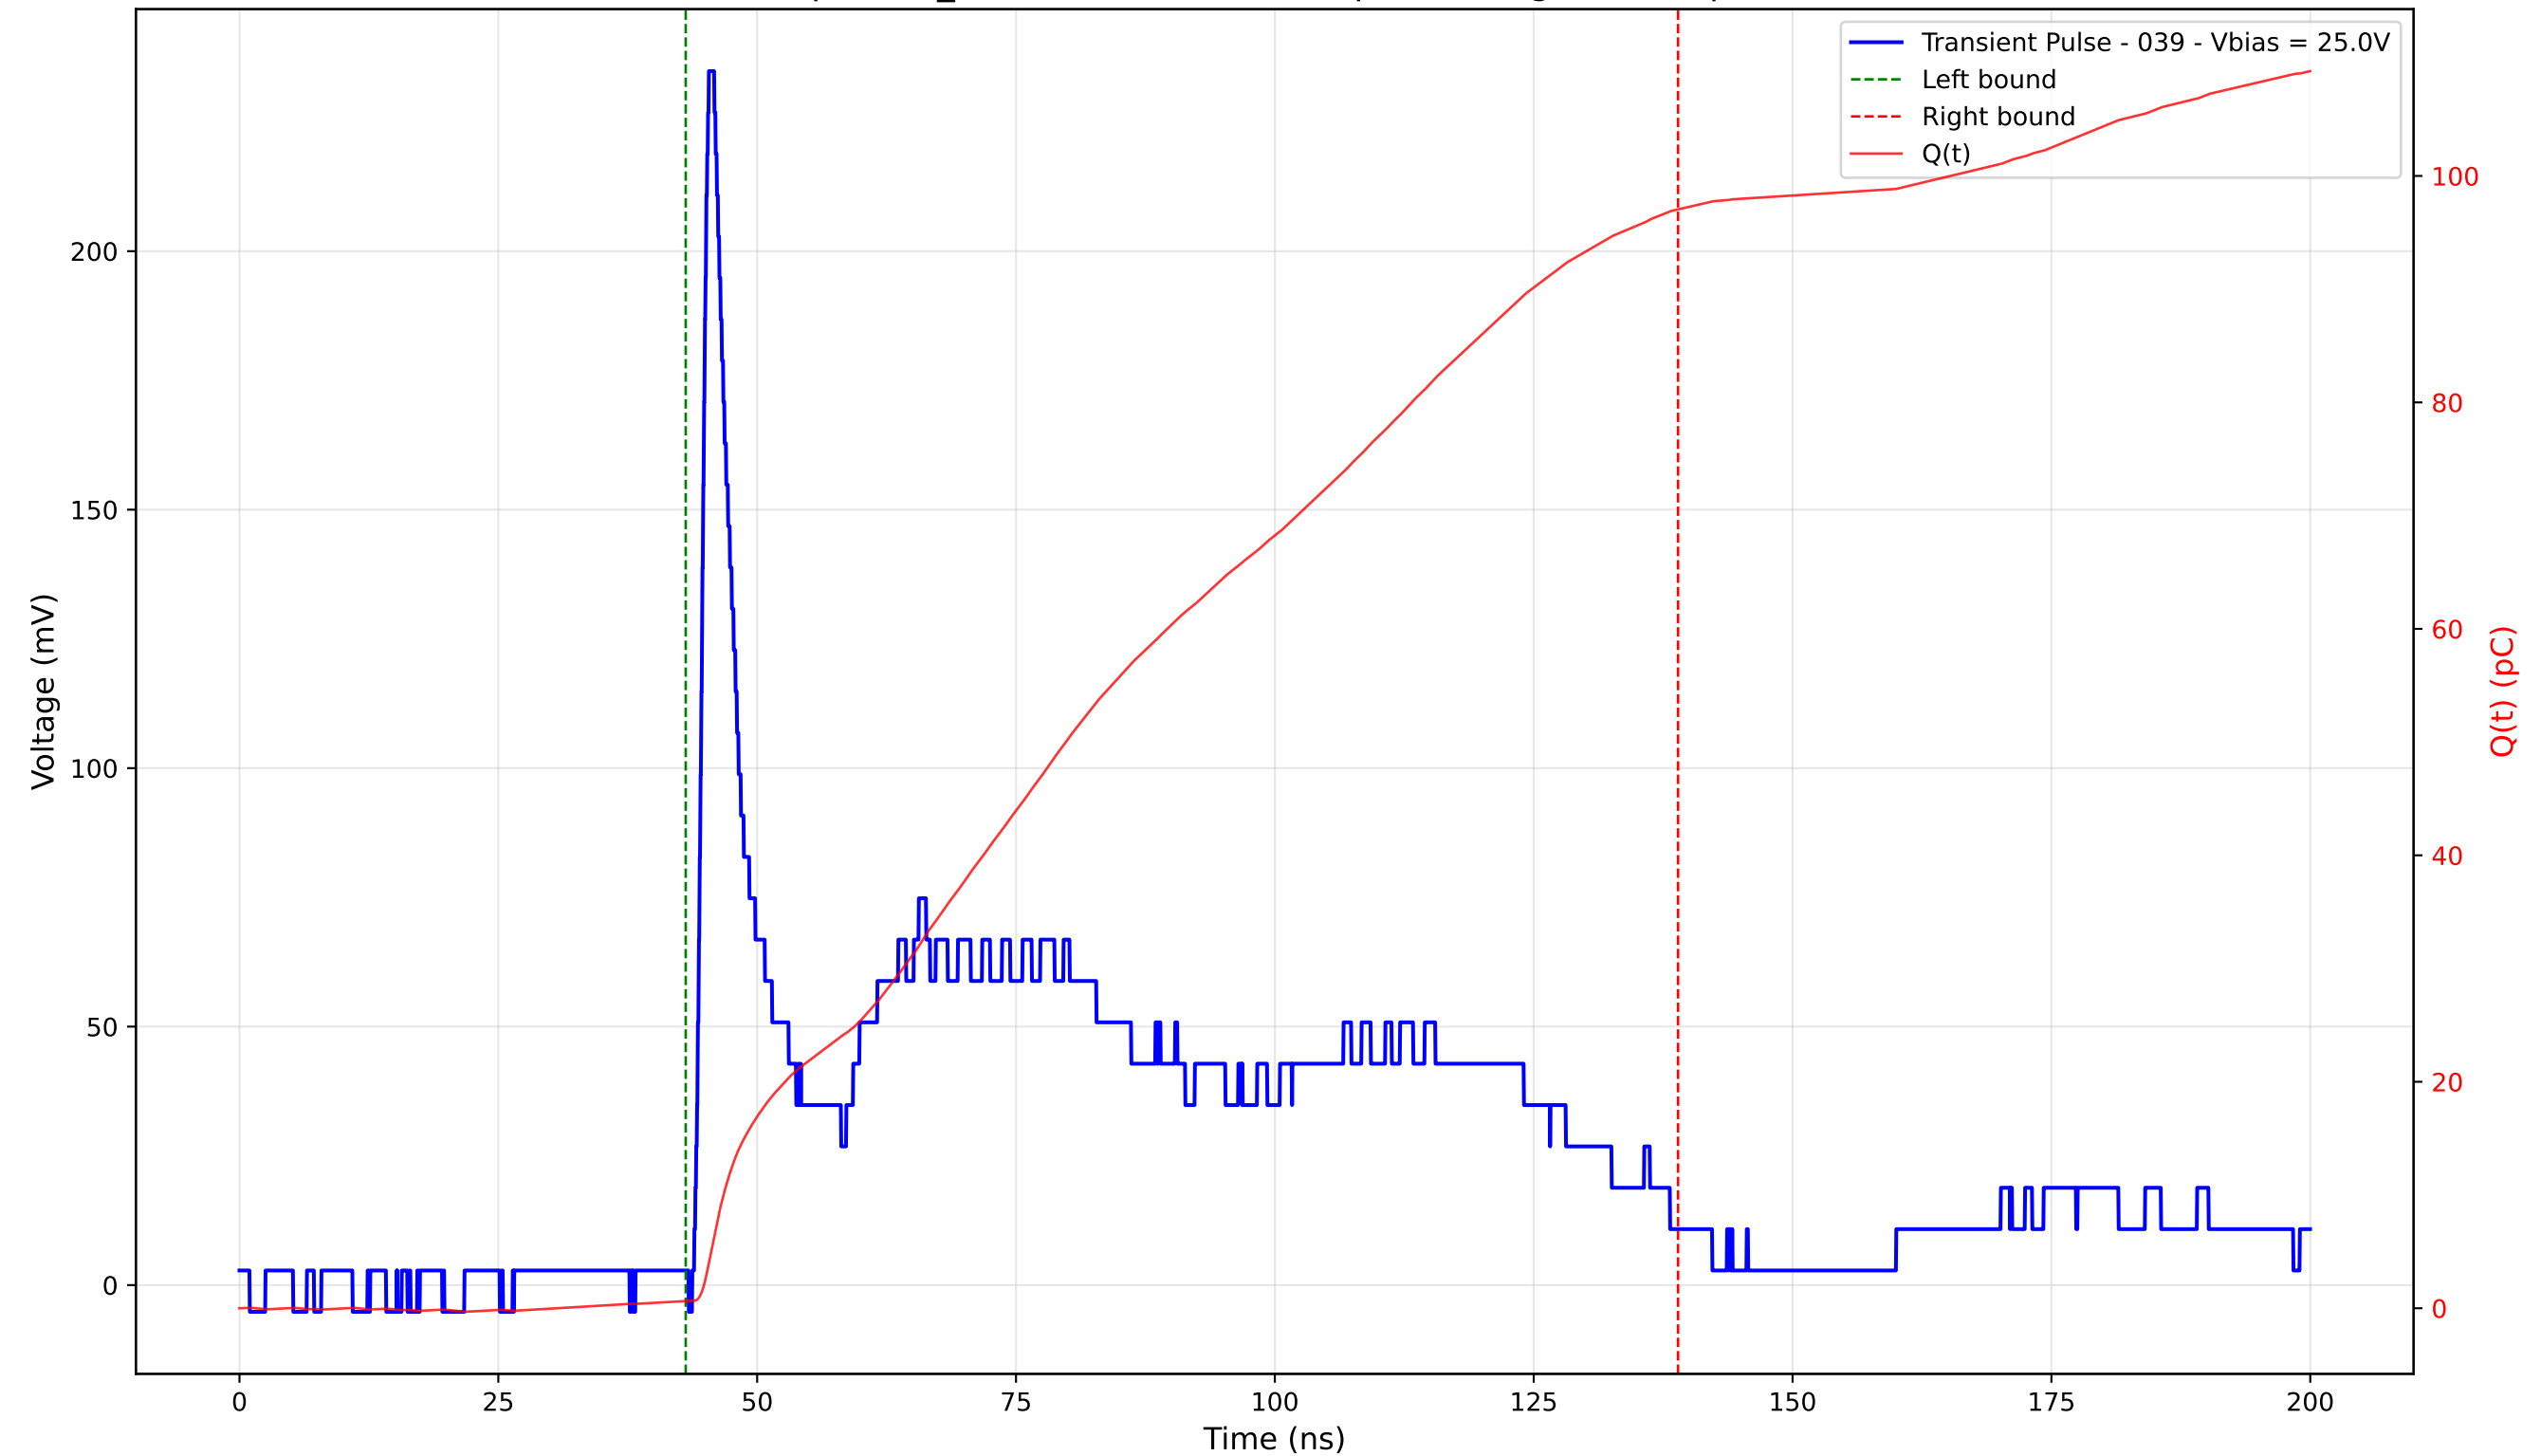


Transient Pulse - Sample: TD_4004 - Position: 205.0 μm - Charge: 88.50 pC - Rise Time: 1.07 ns

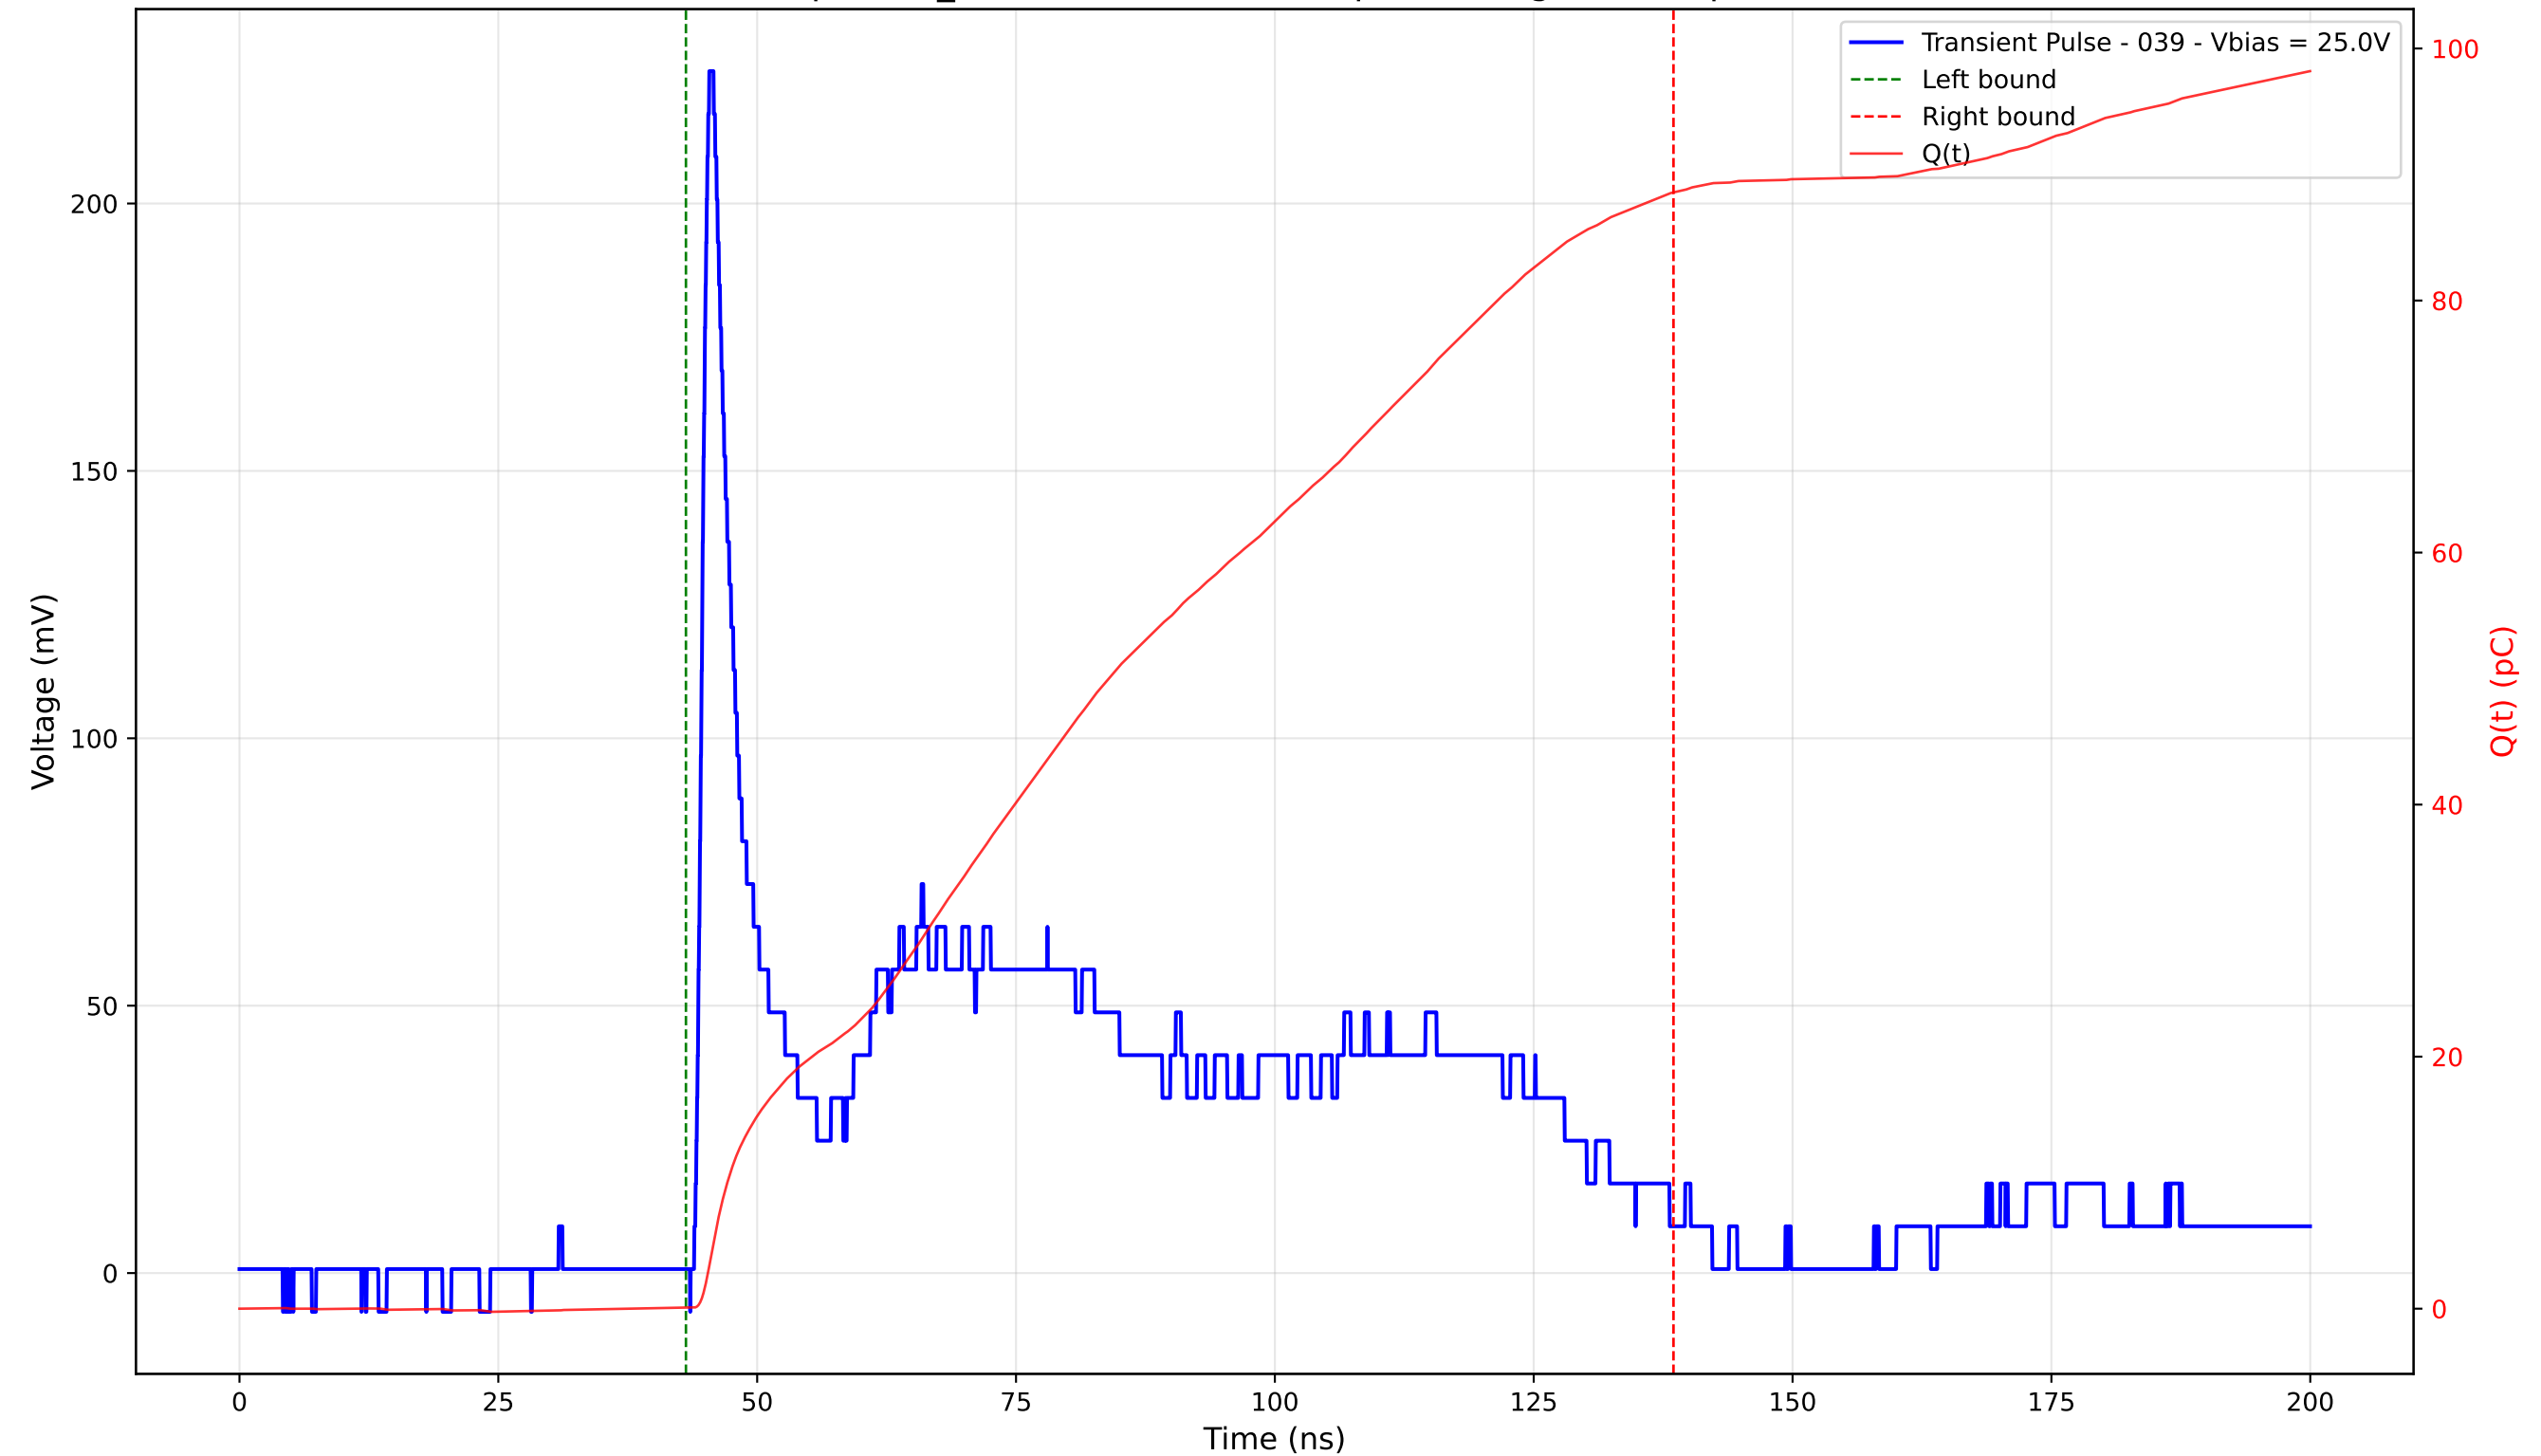


Transient Pulse - Sample: TD_4004 - Position: 210.0 μm - Charge: 82.35 pC - Rise Time: 1.05 ns

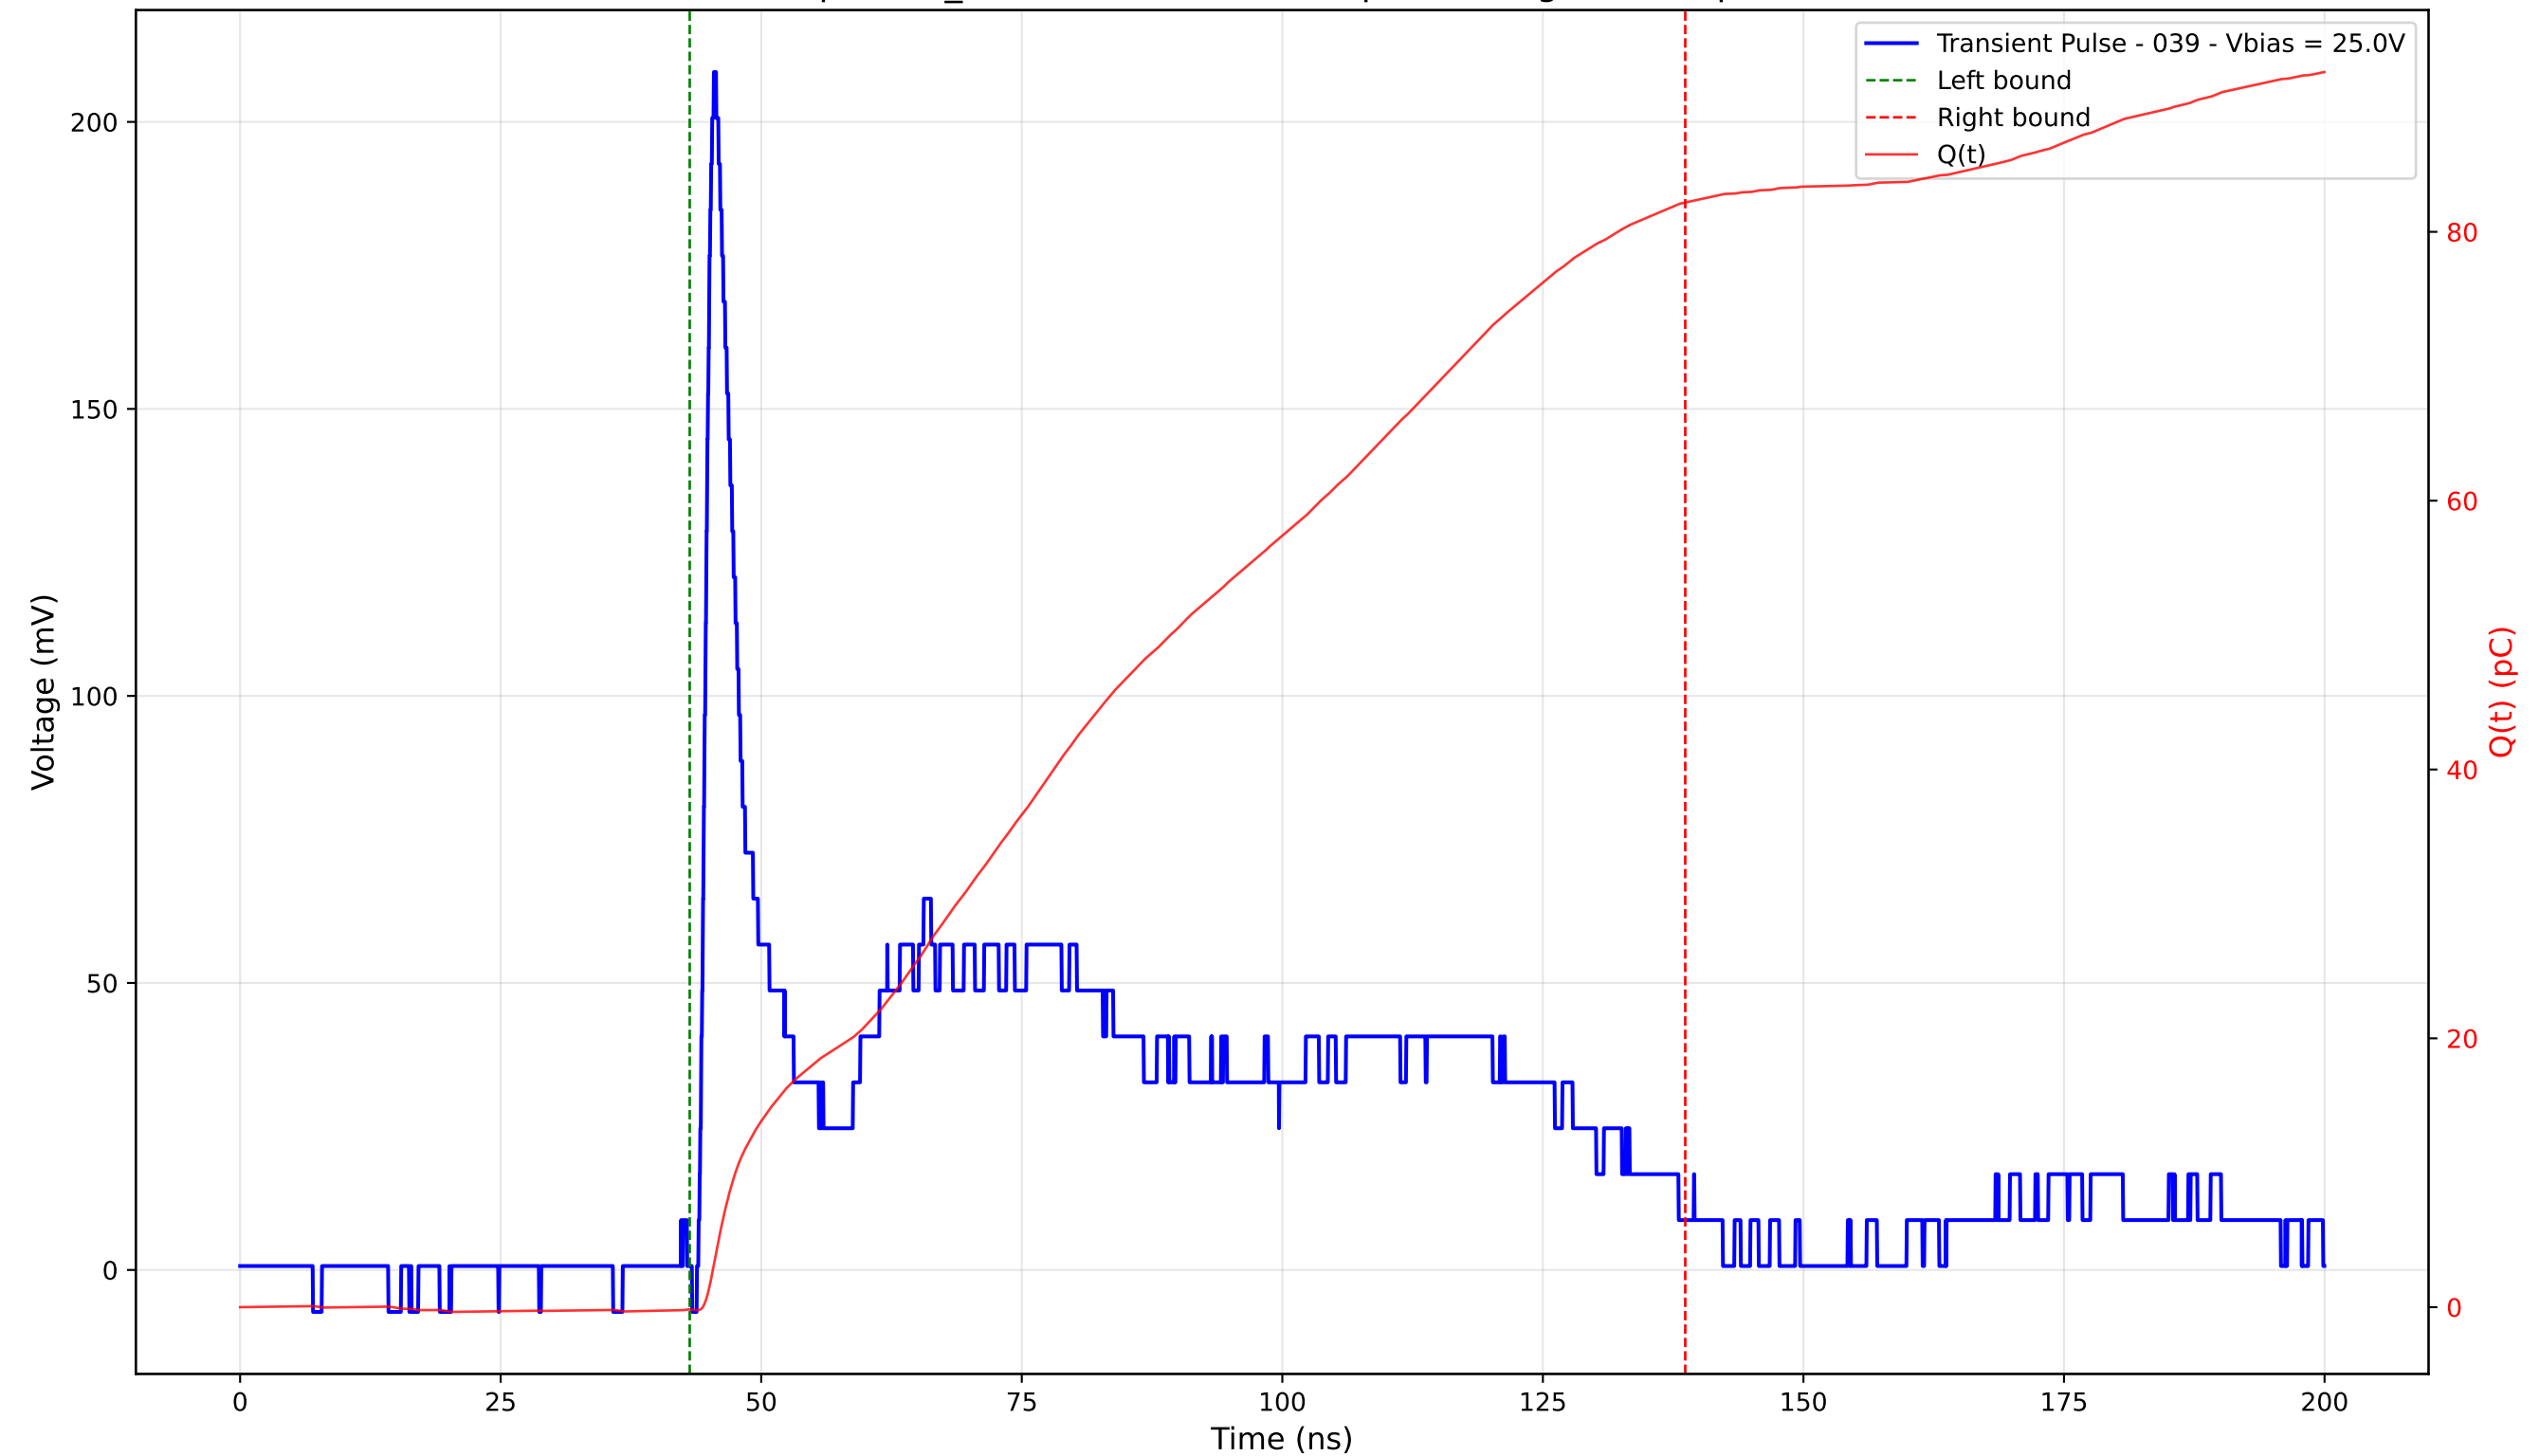


Transient Pulse - Sample: TD_4004 - Position: 215.0 μm - Charge: 83.83 pC - Rise Time: 1.04 ns

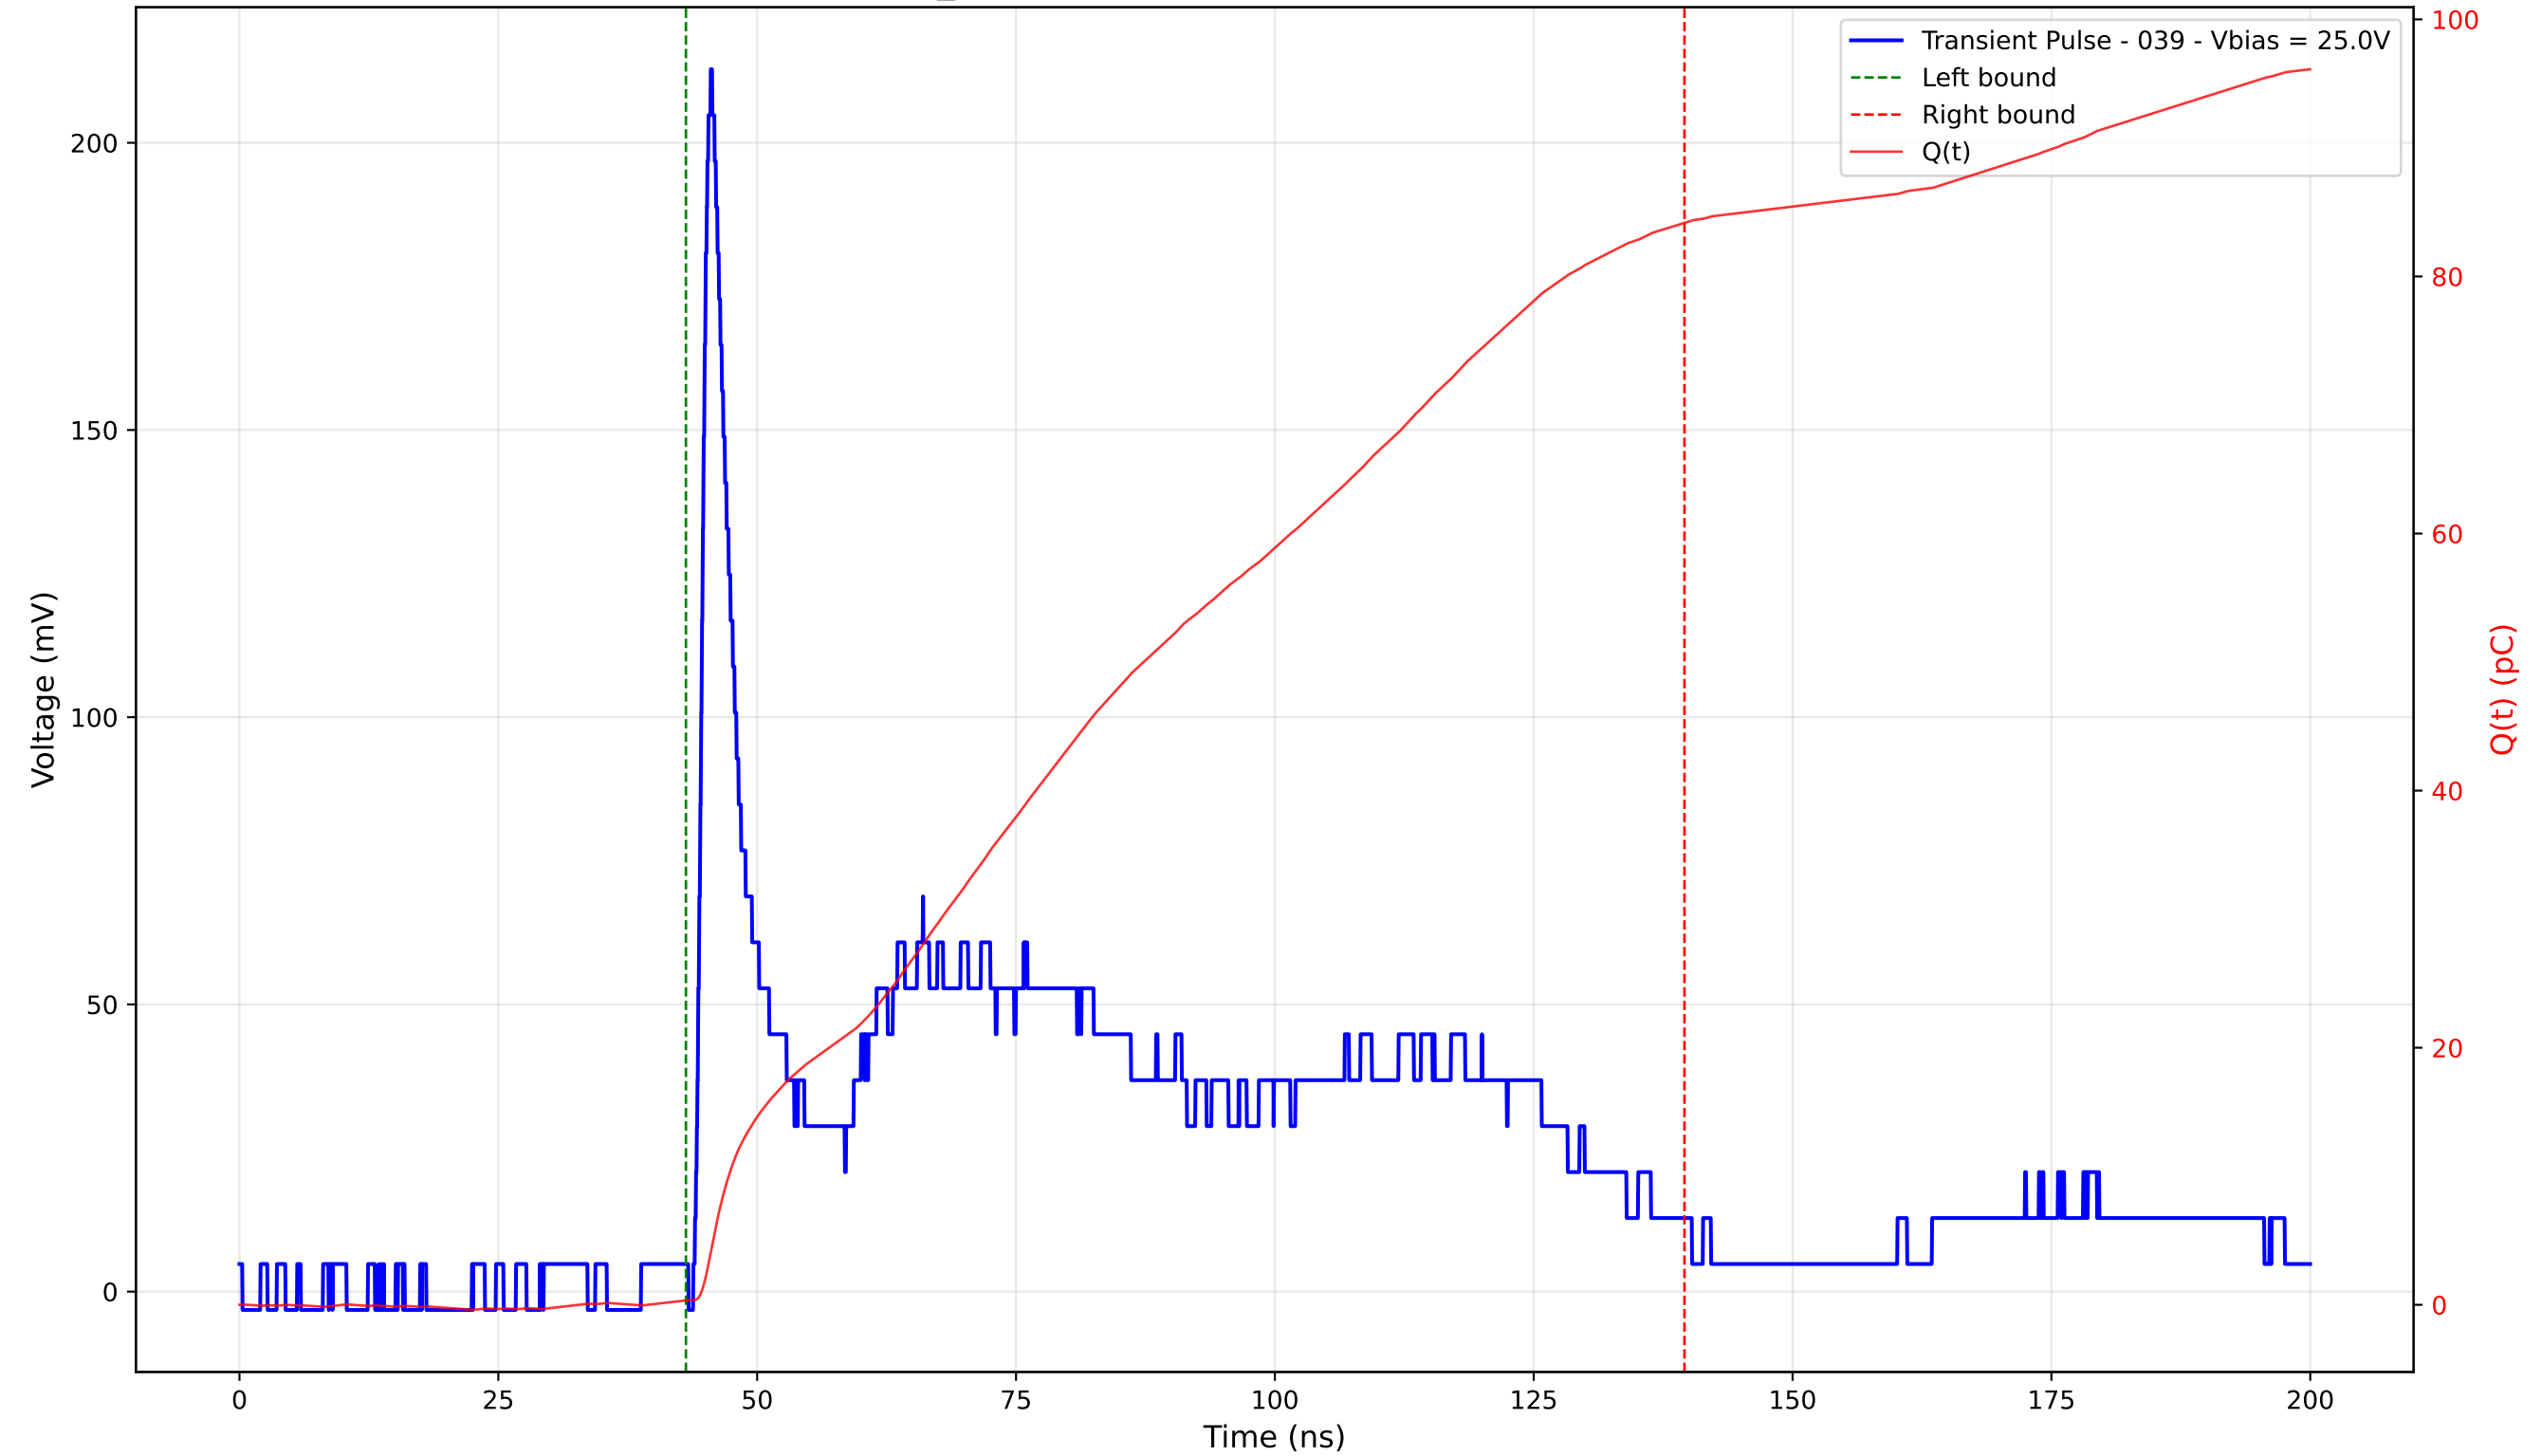


Transient Pulse - Sample: TD_4004 - Position: 220.0 μm - Charge: 83.27 pC - Rise Time: 1.01 ns

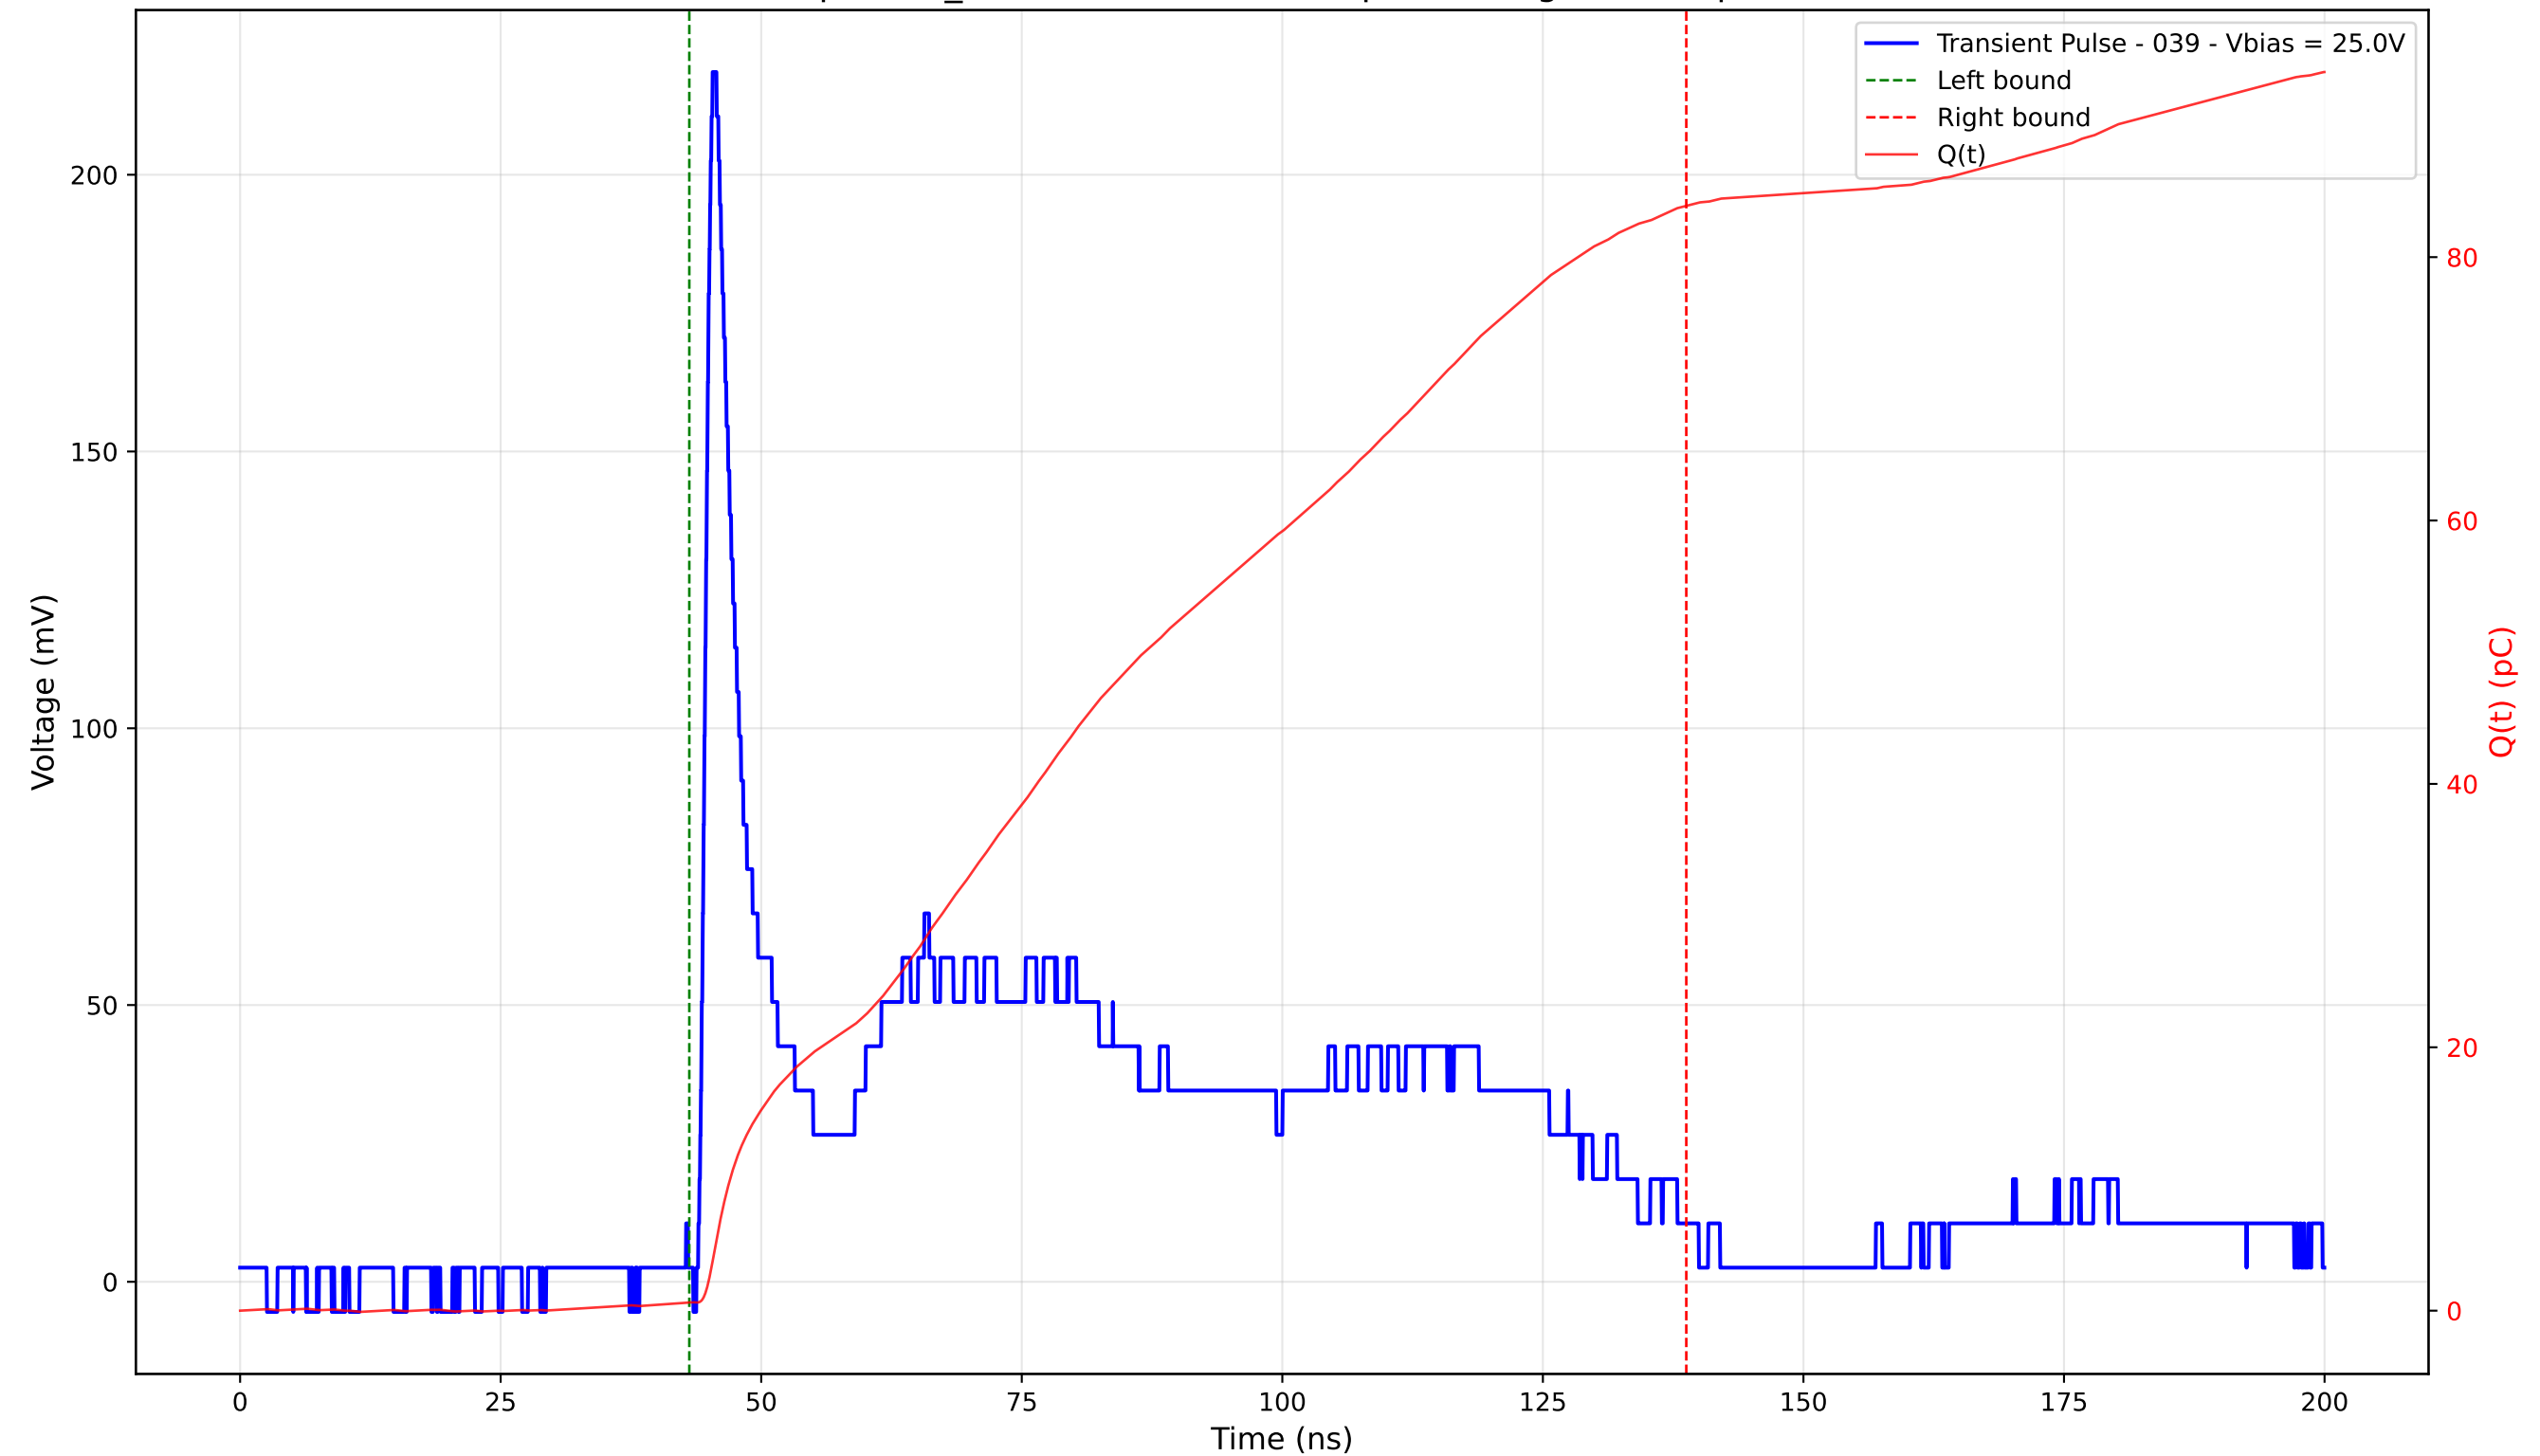


Transient Pulse - Sample: TD_4004 - Position: 225.0 μm - Charge: 74.99 pC - Rise Time: 1.03 ns

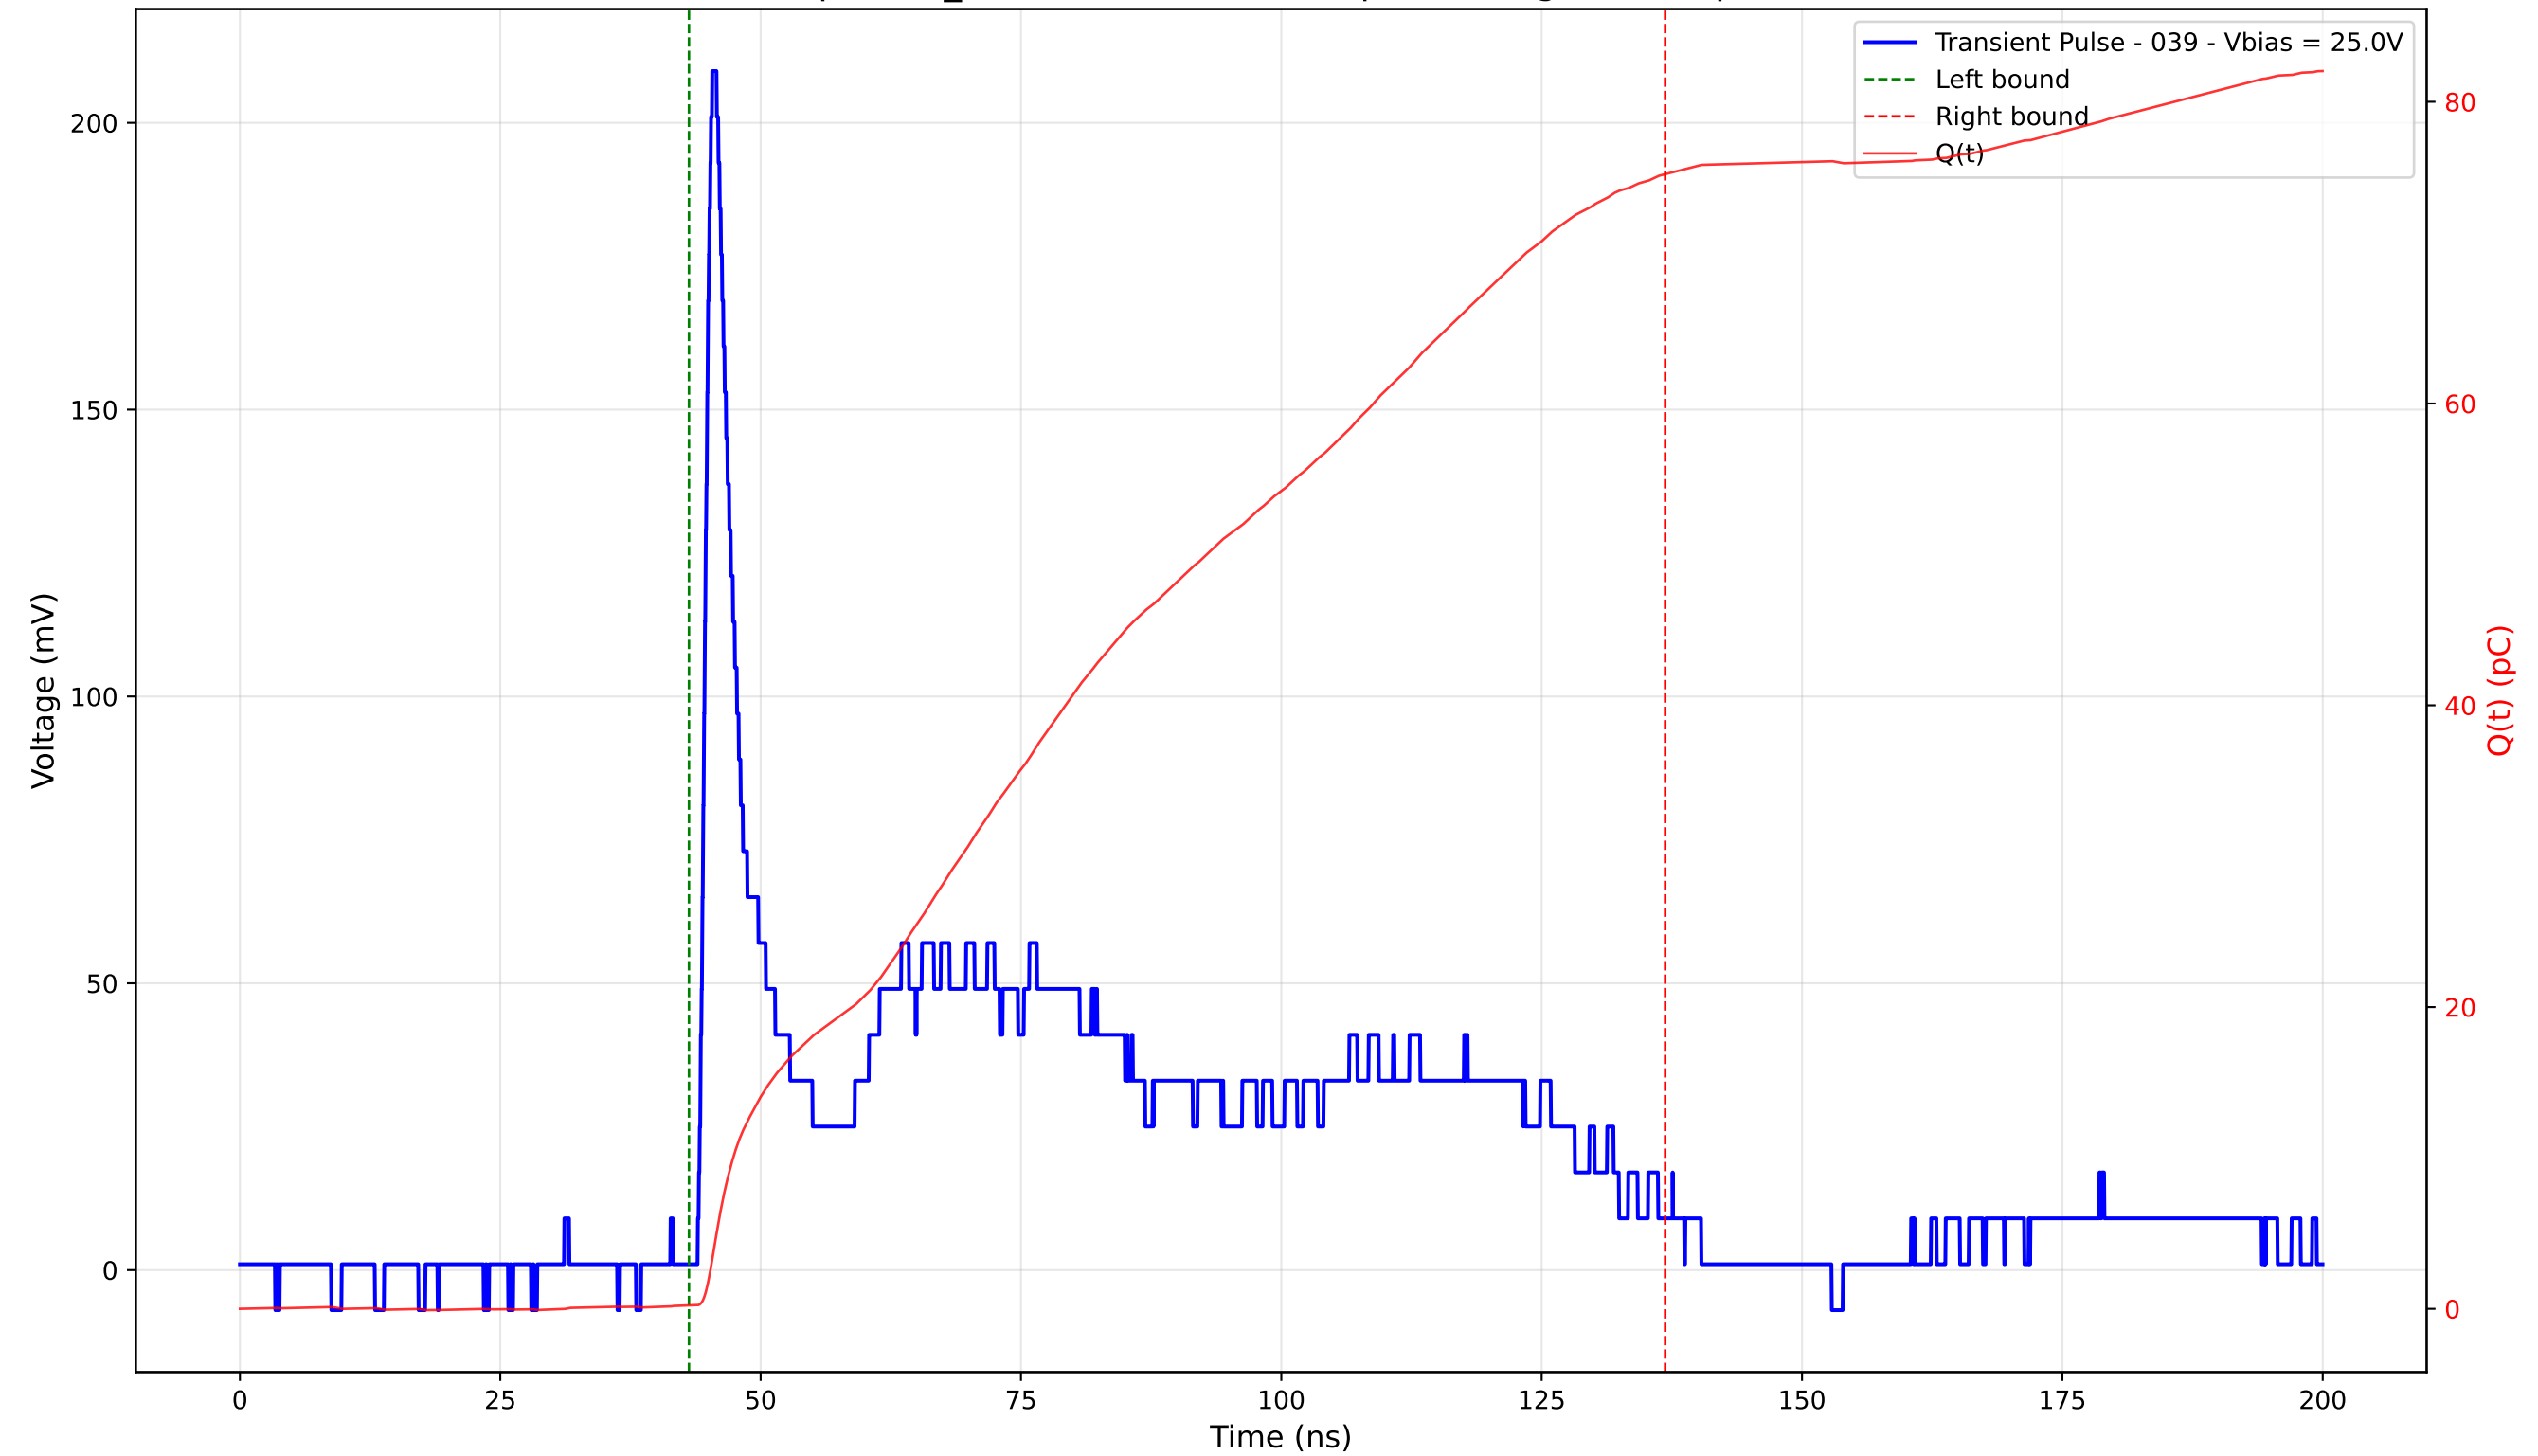


Transient Pulse - Sample: TD_4004 - Position: 230.0 μm - Charge: 66.64 pC - Rise Time: 1.00 ns

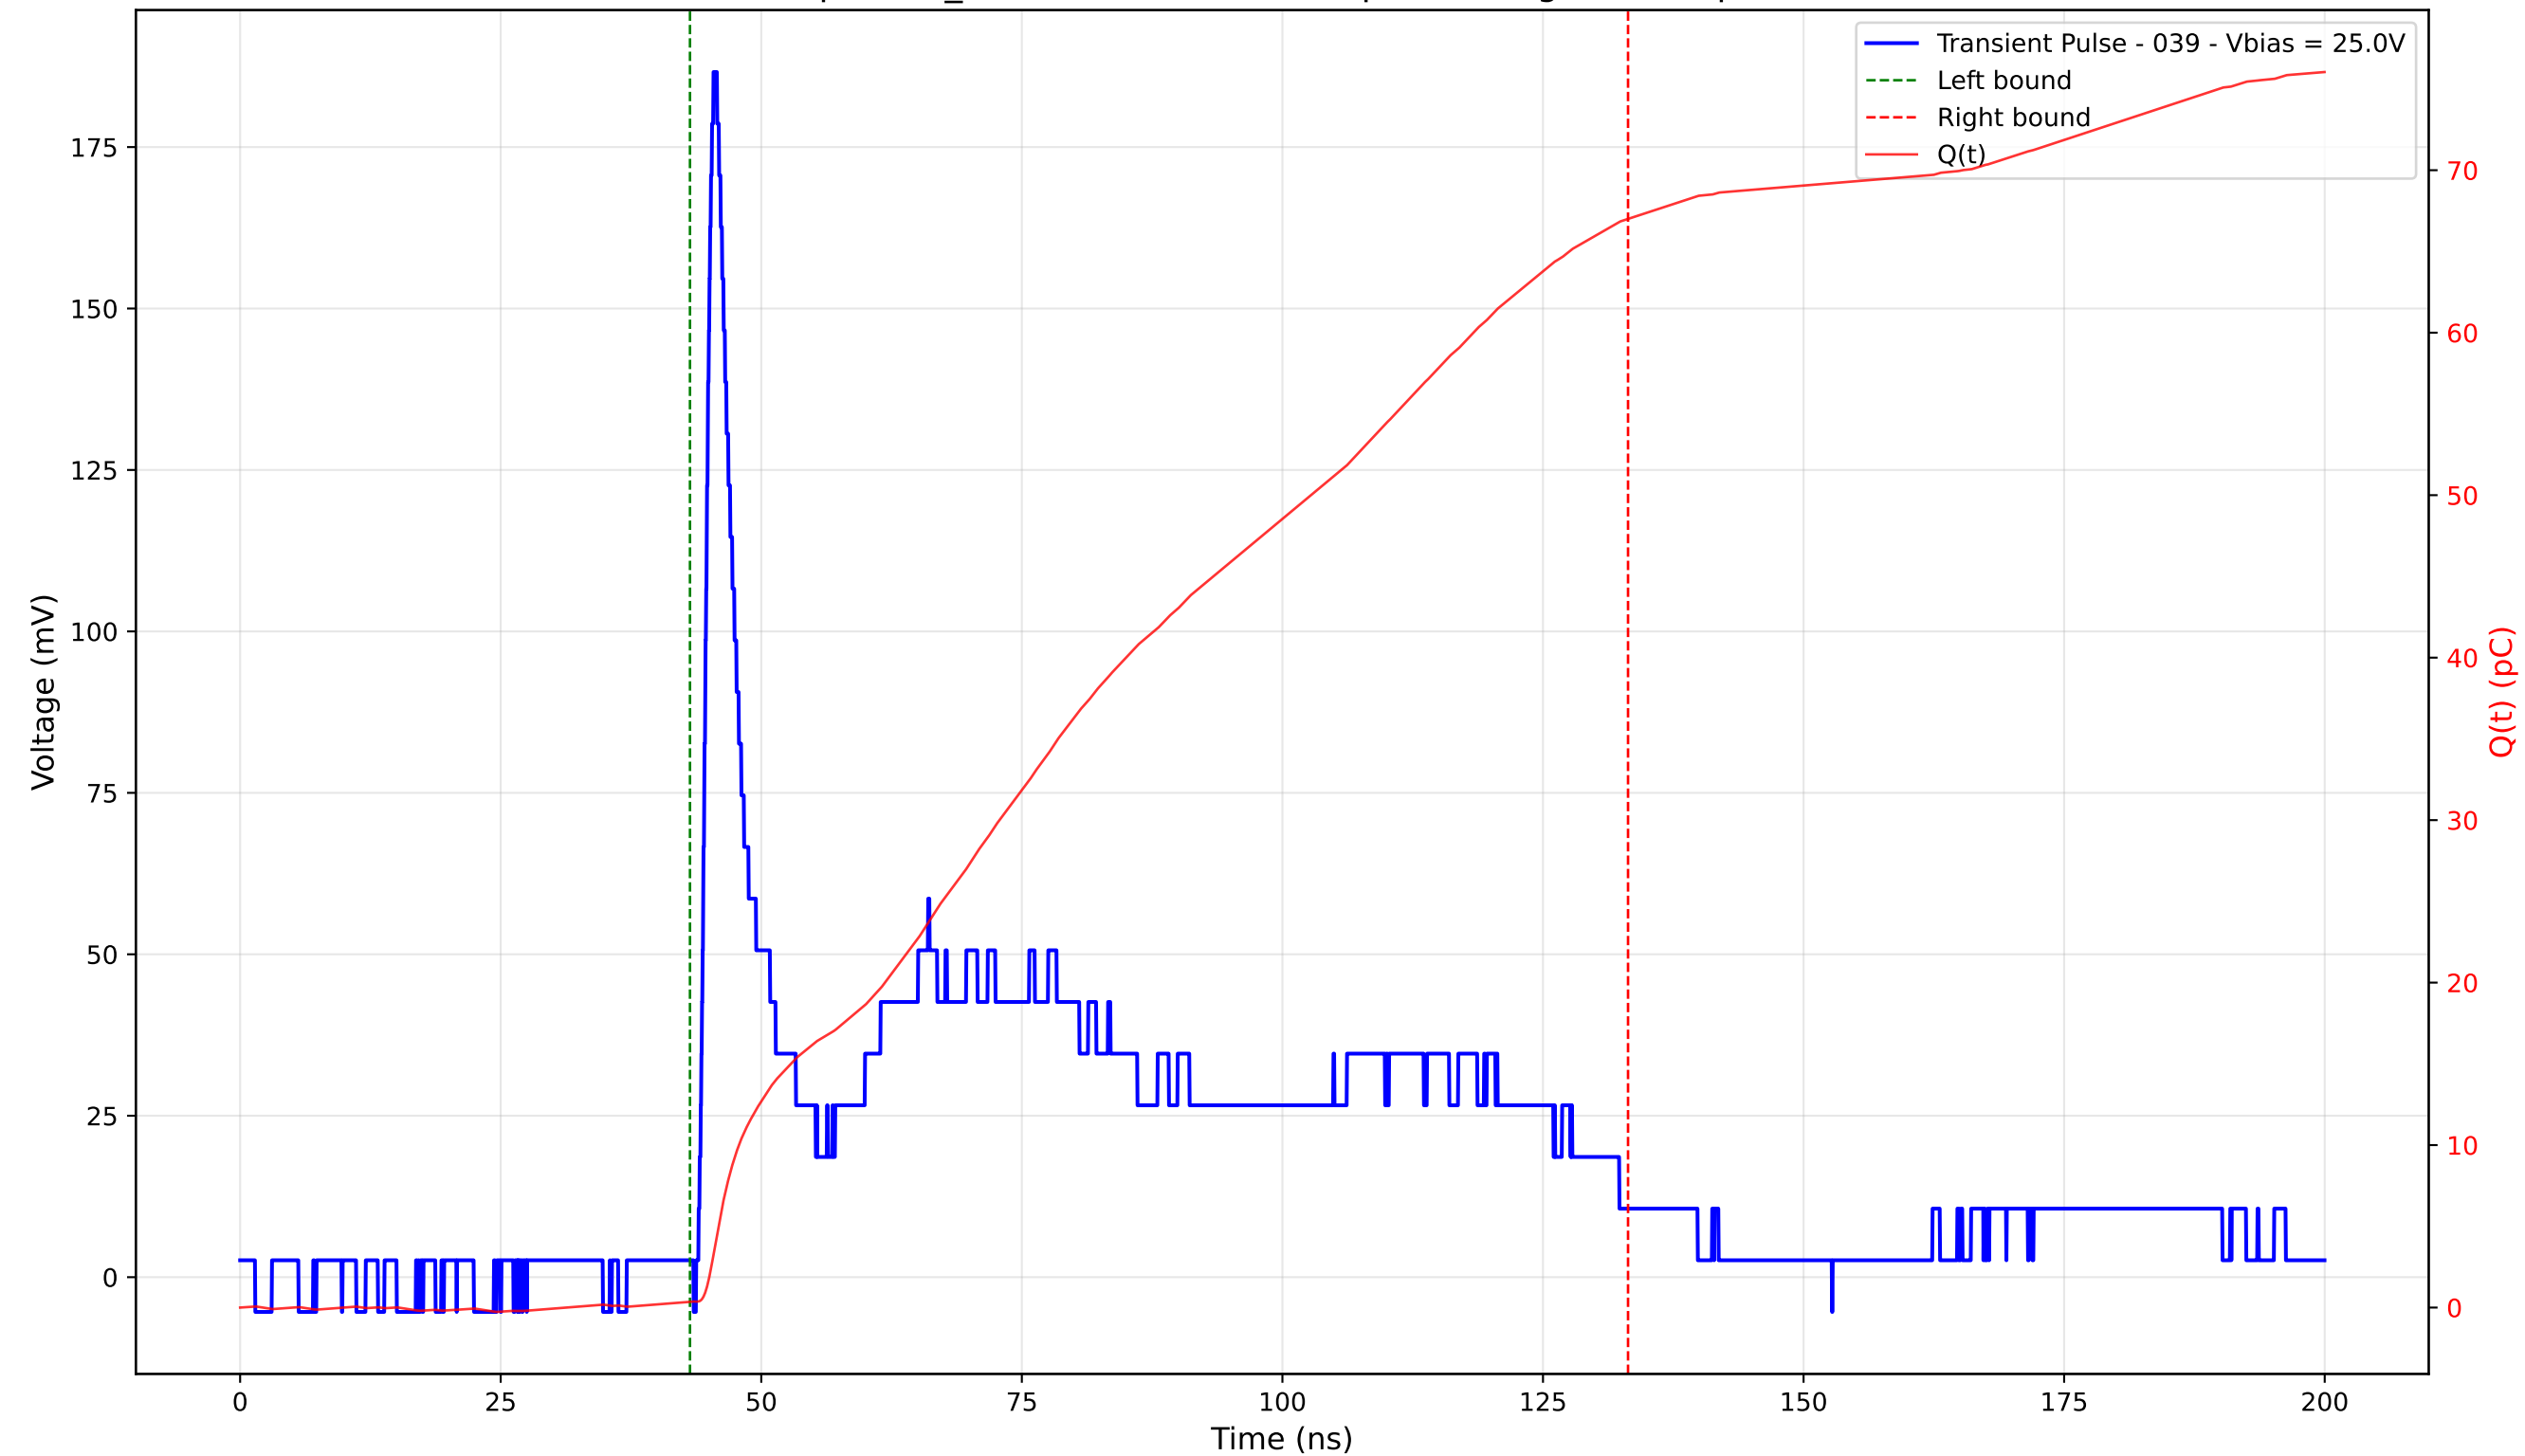


Transient Pulse - Sample: TD_4004 - Position: 235.0 μm - Charge: 61.93 pC - Rise Time: 1.03 ns

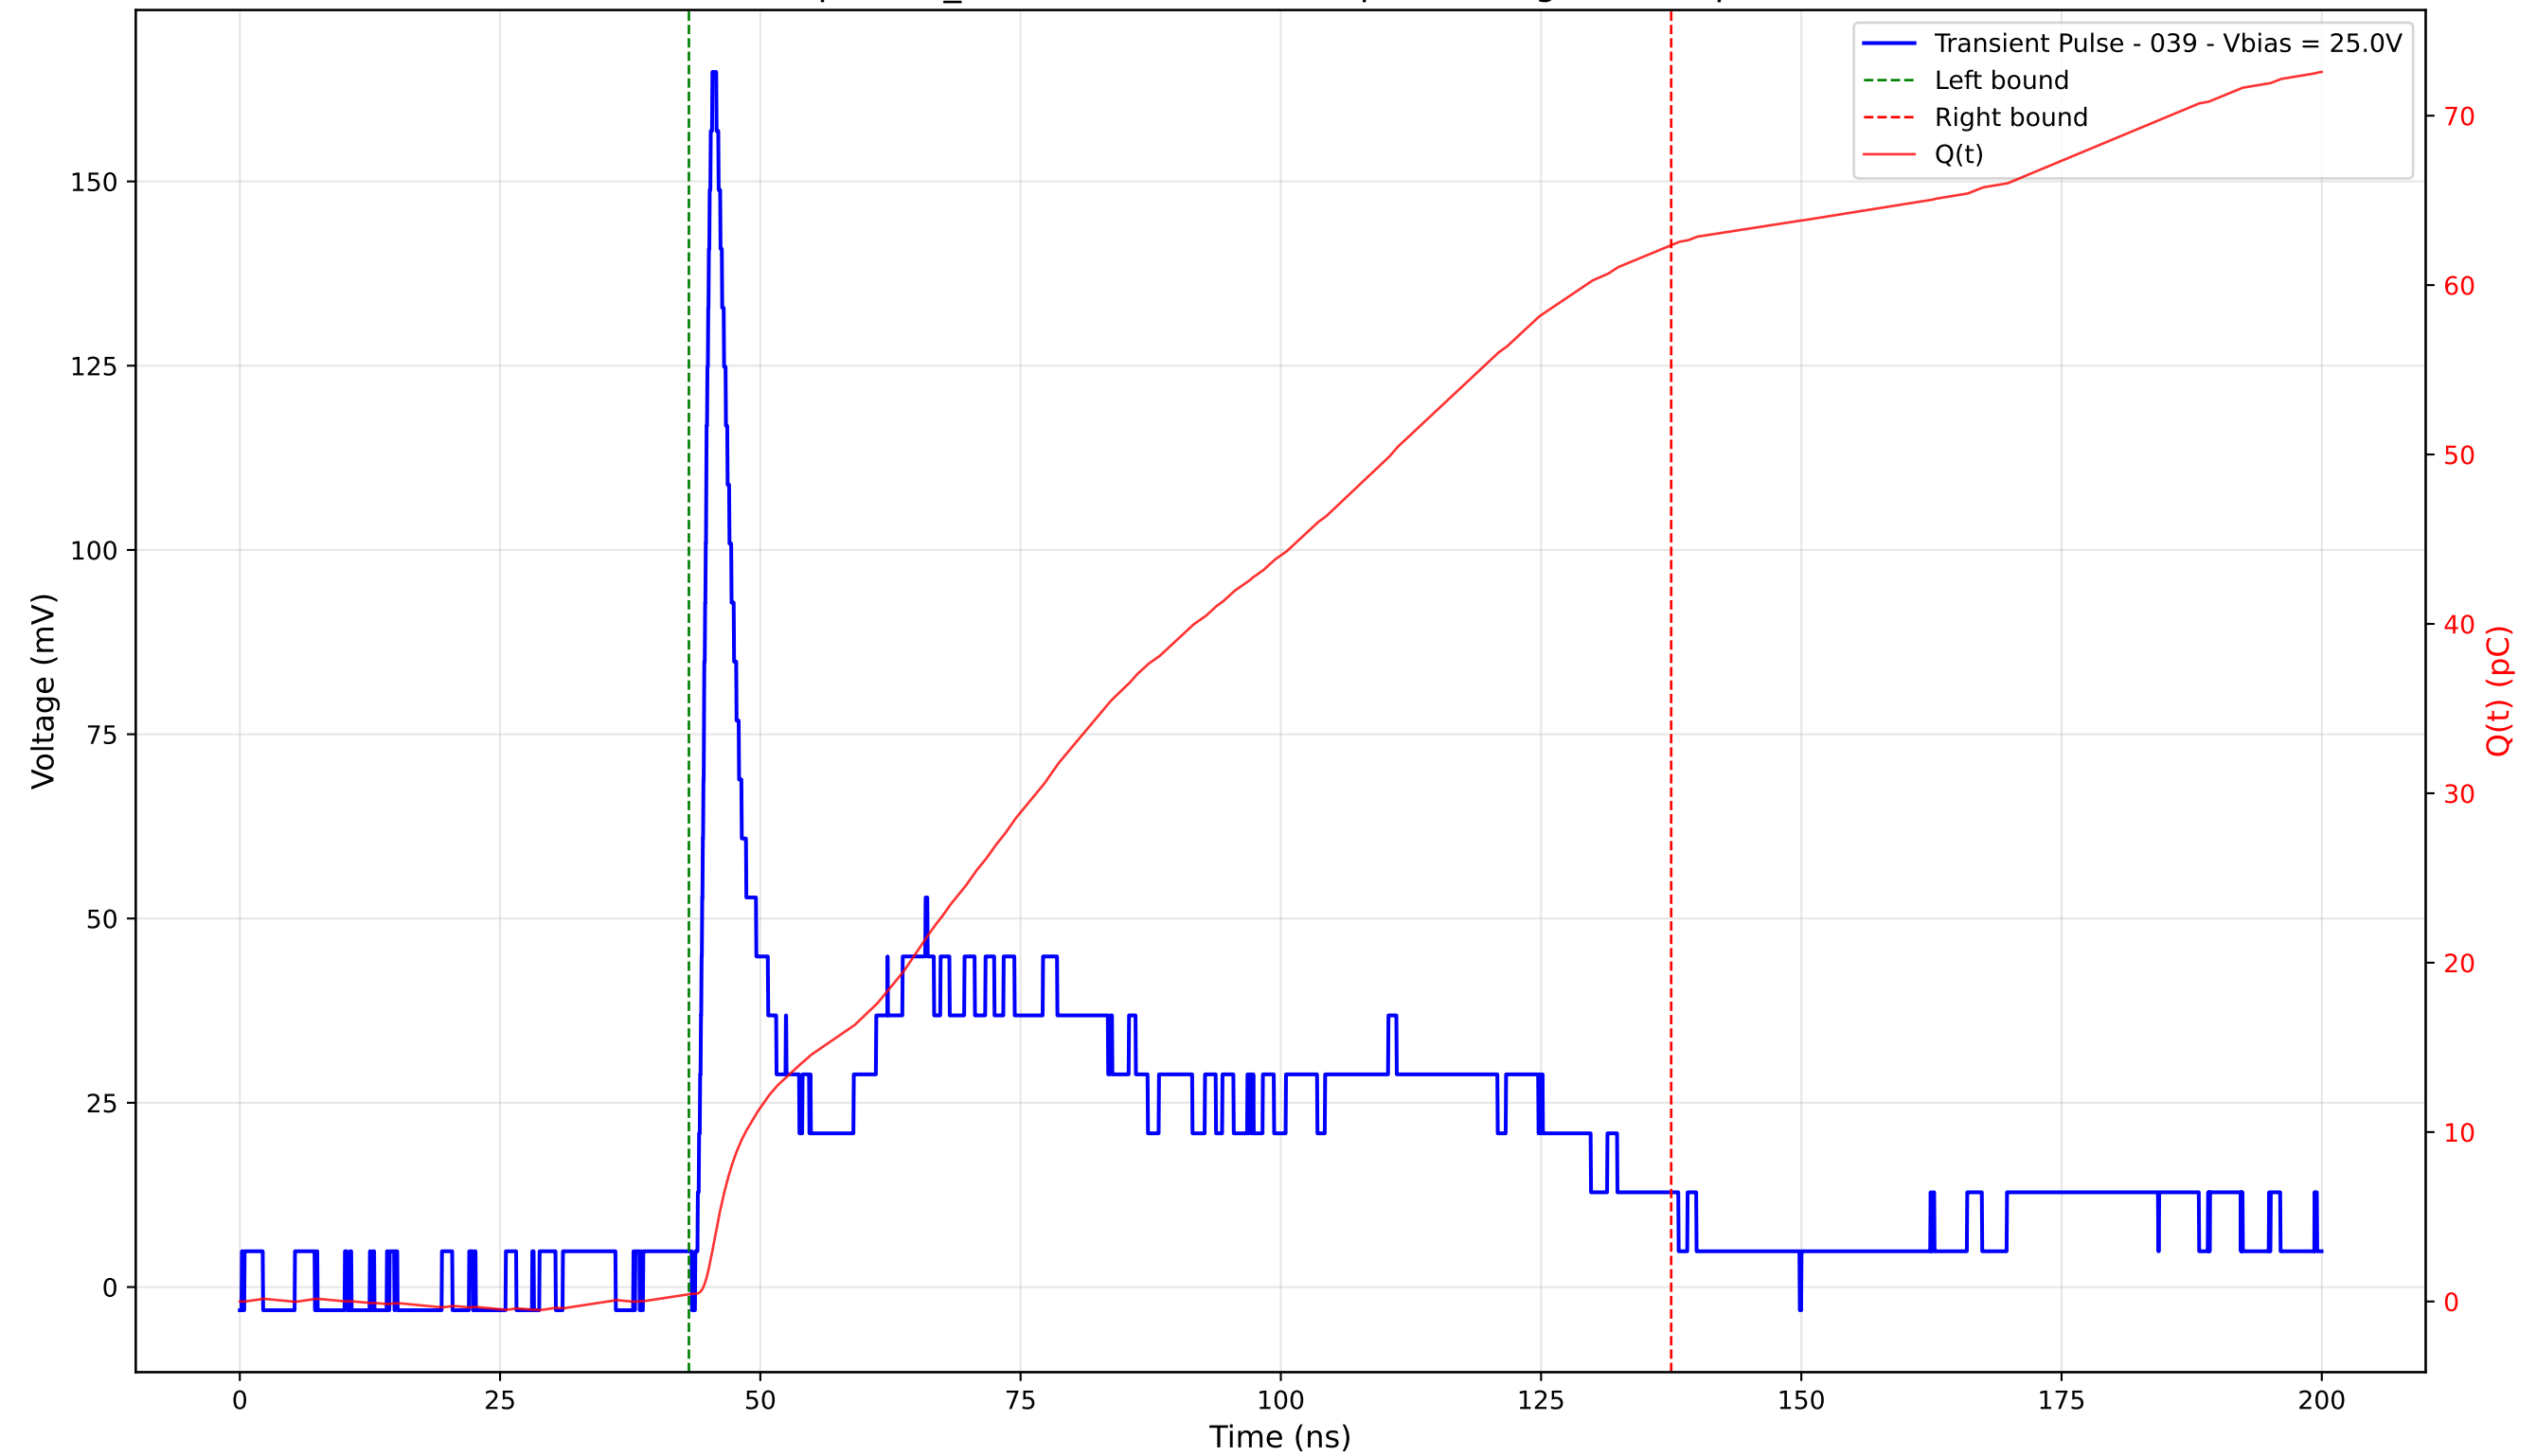


Transient Pulse - Sample: TD_4004 - Position: 240.0 μm - Charge: 55.27 pC - Rise Time: 1.07 ns

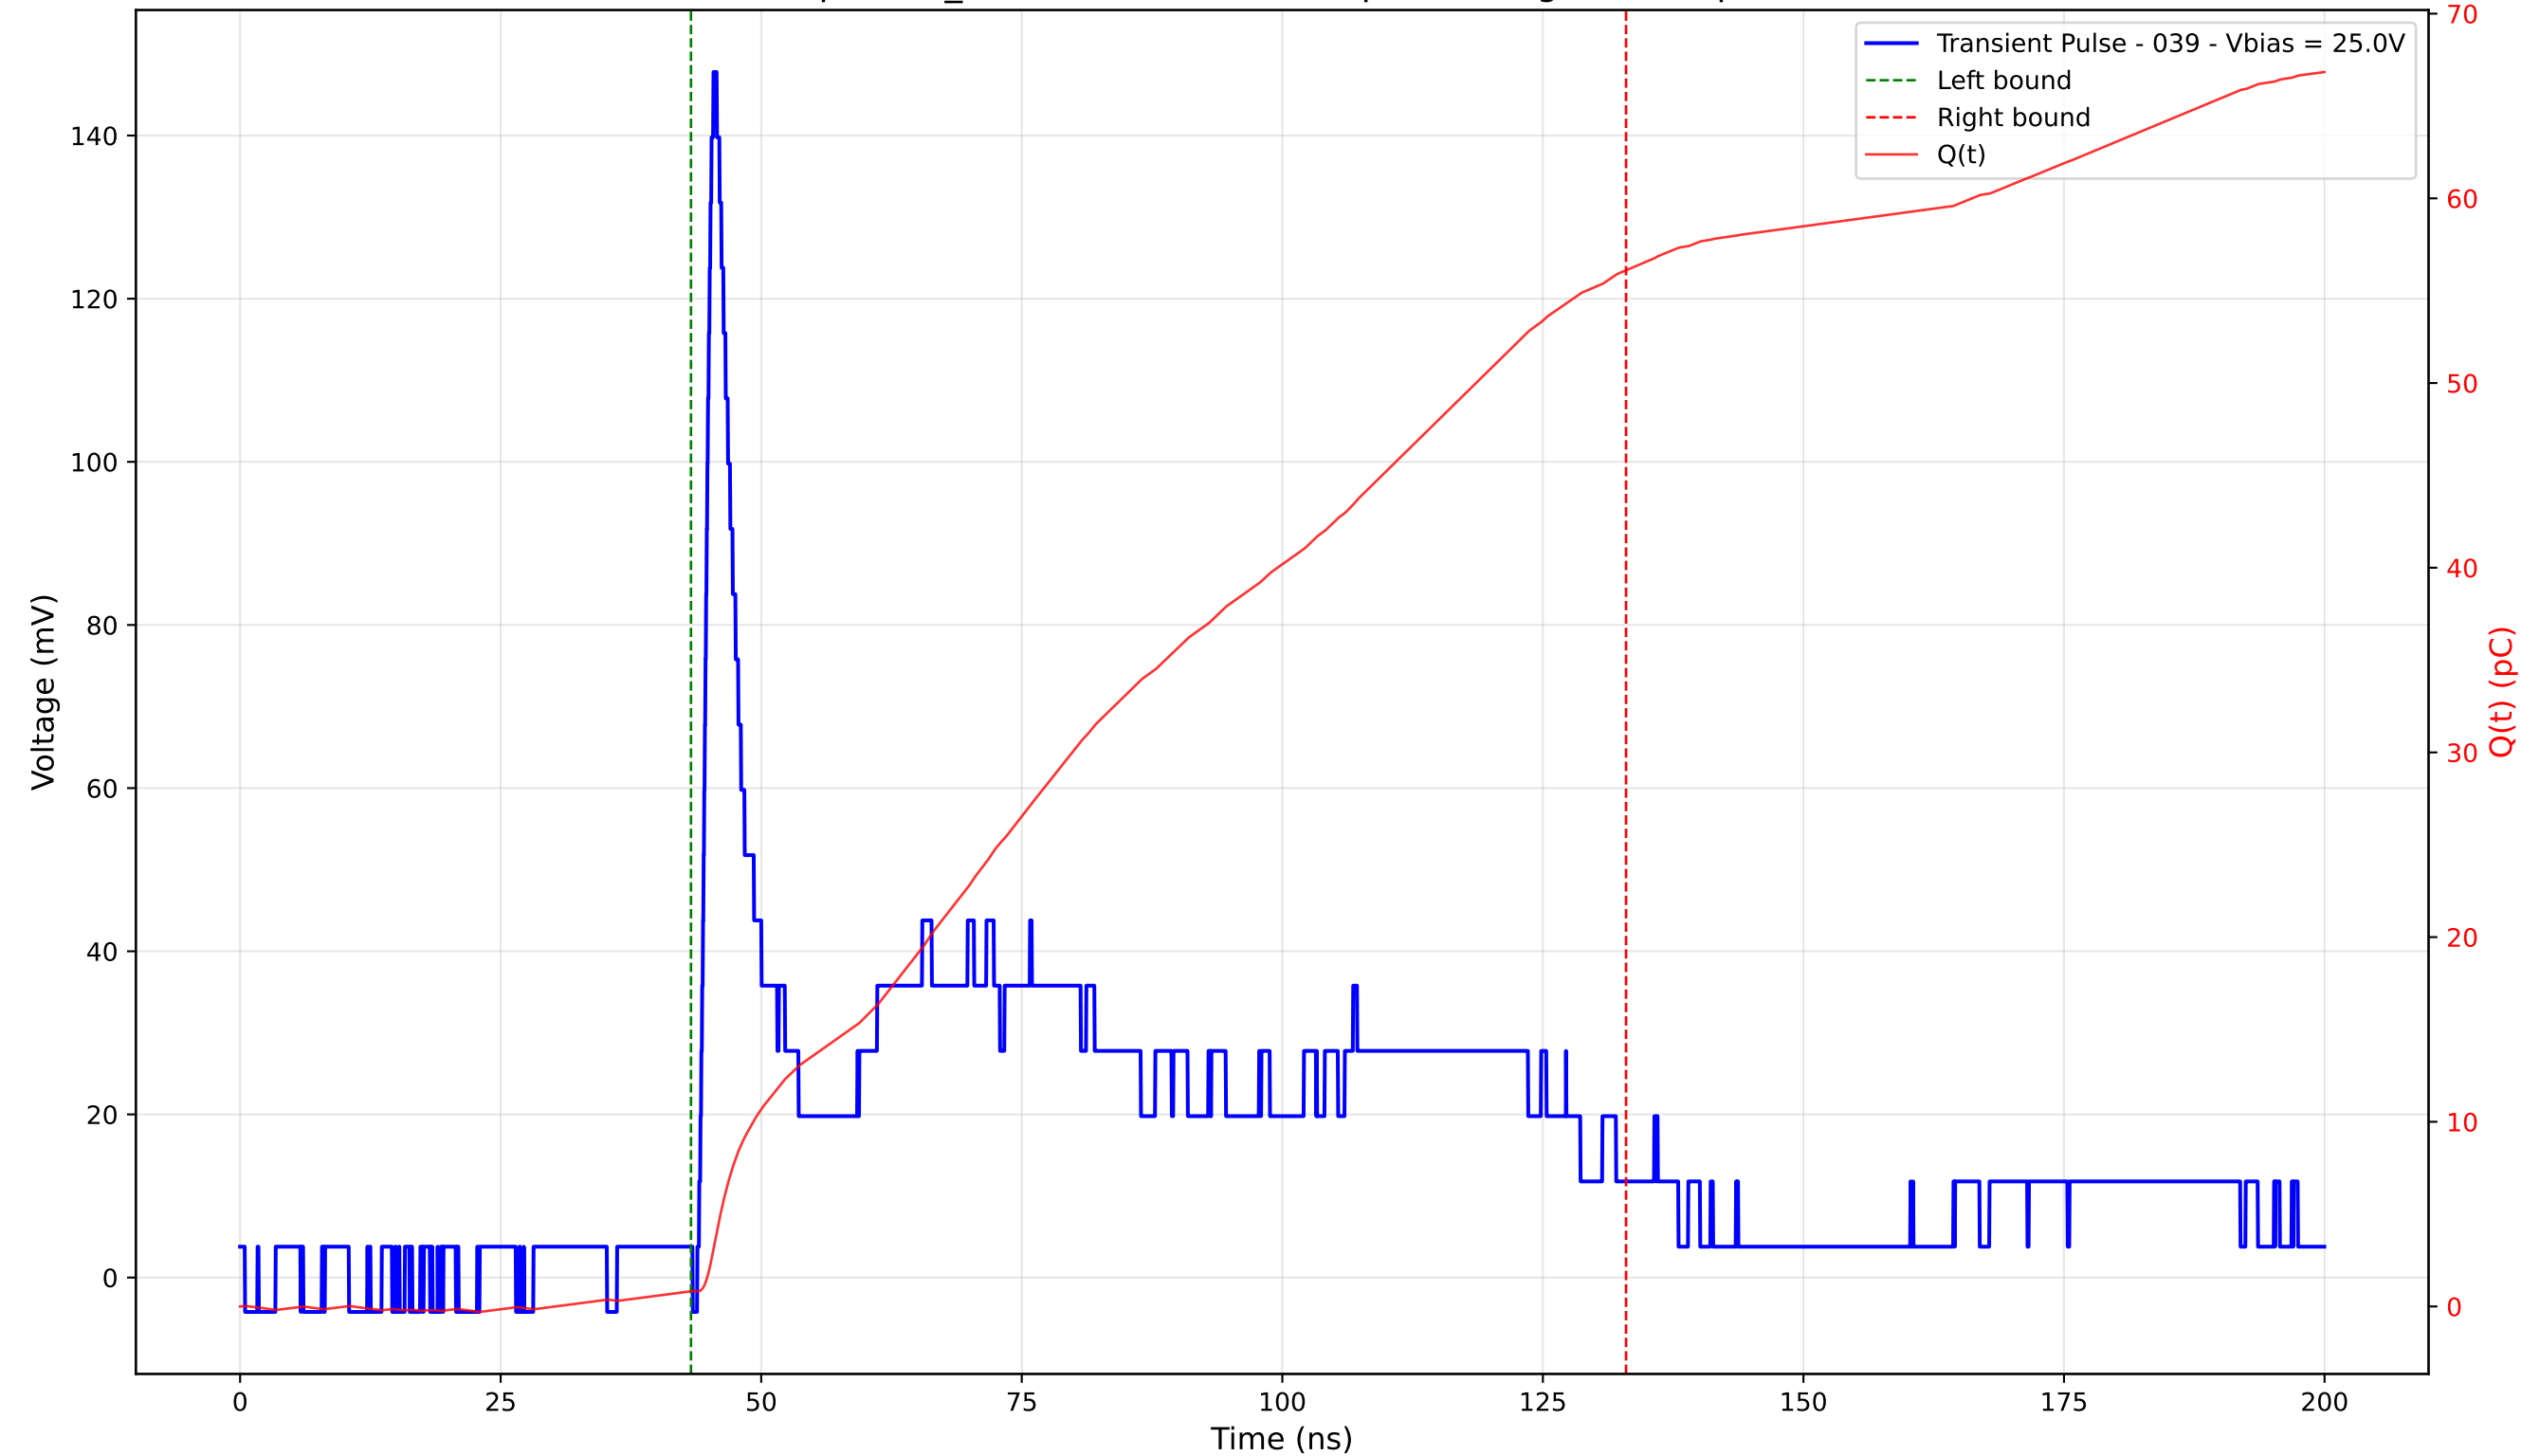


Transient Pulse - Sample: TD_4004 - Position: 245.0 μm - Charge: 51.92 pC - Rise Time: 1.07 ns

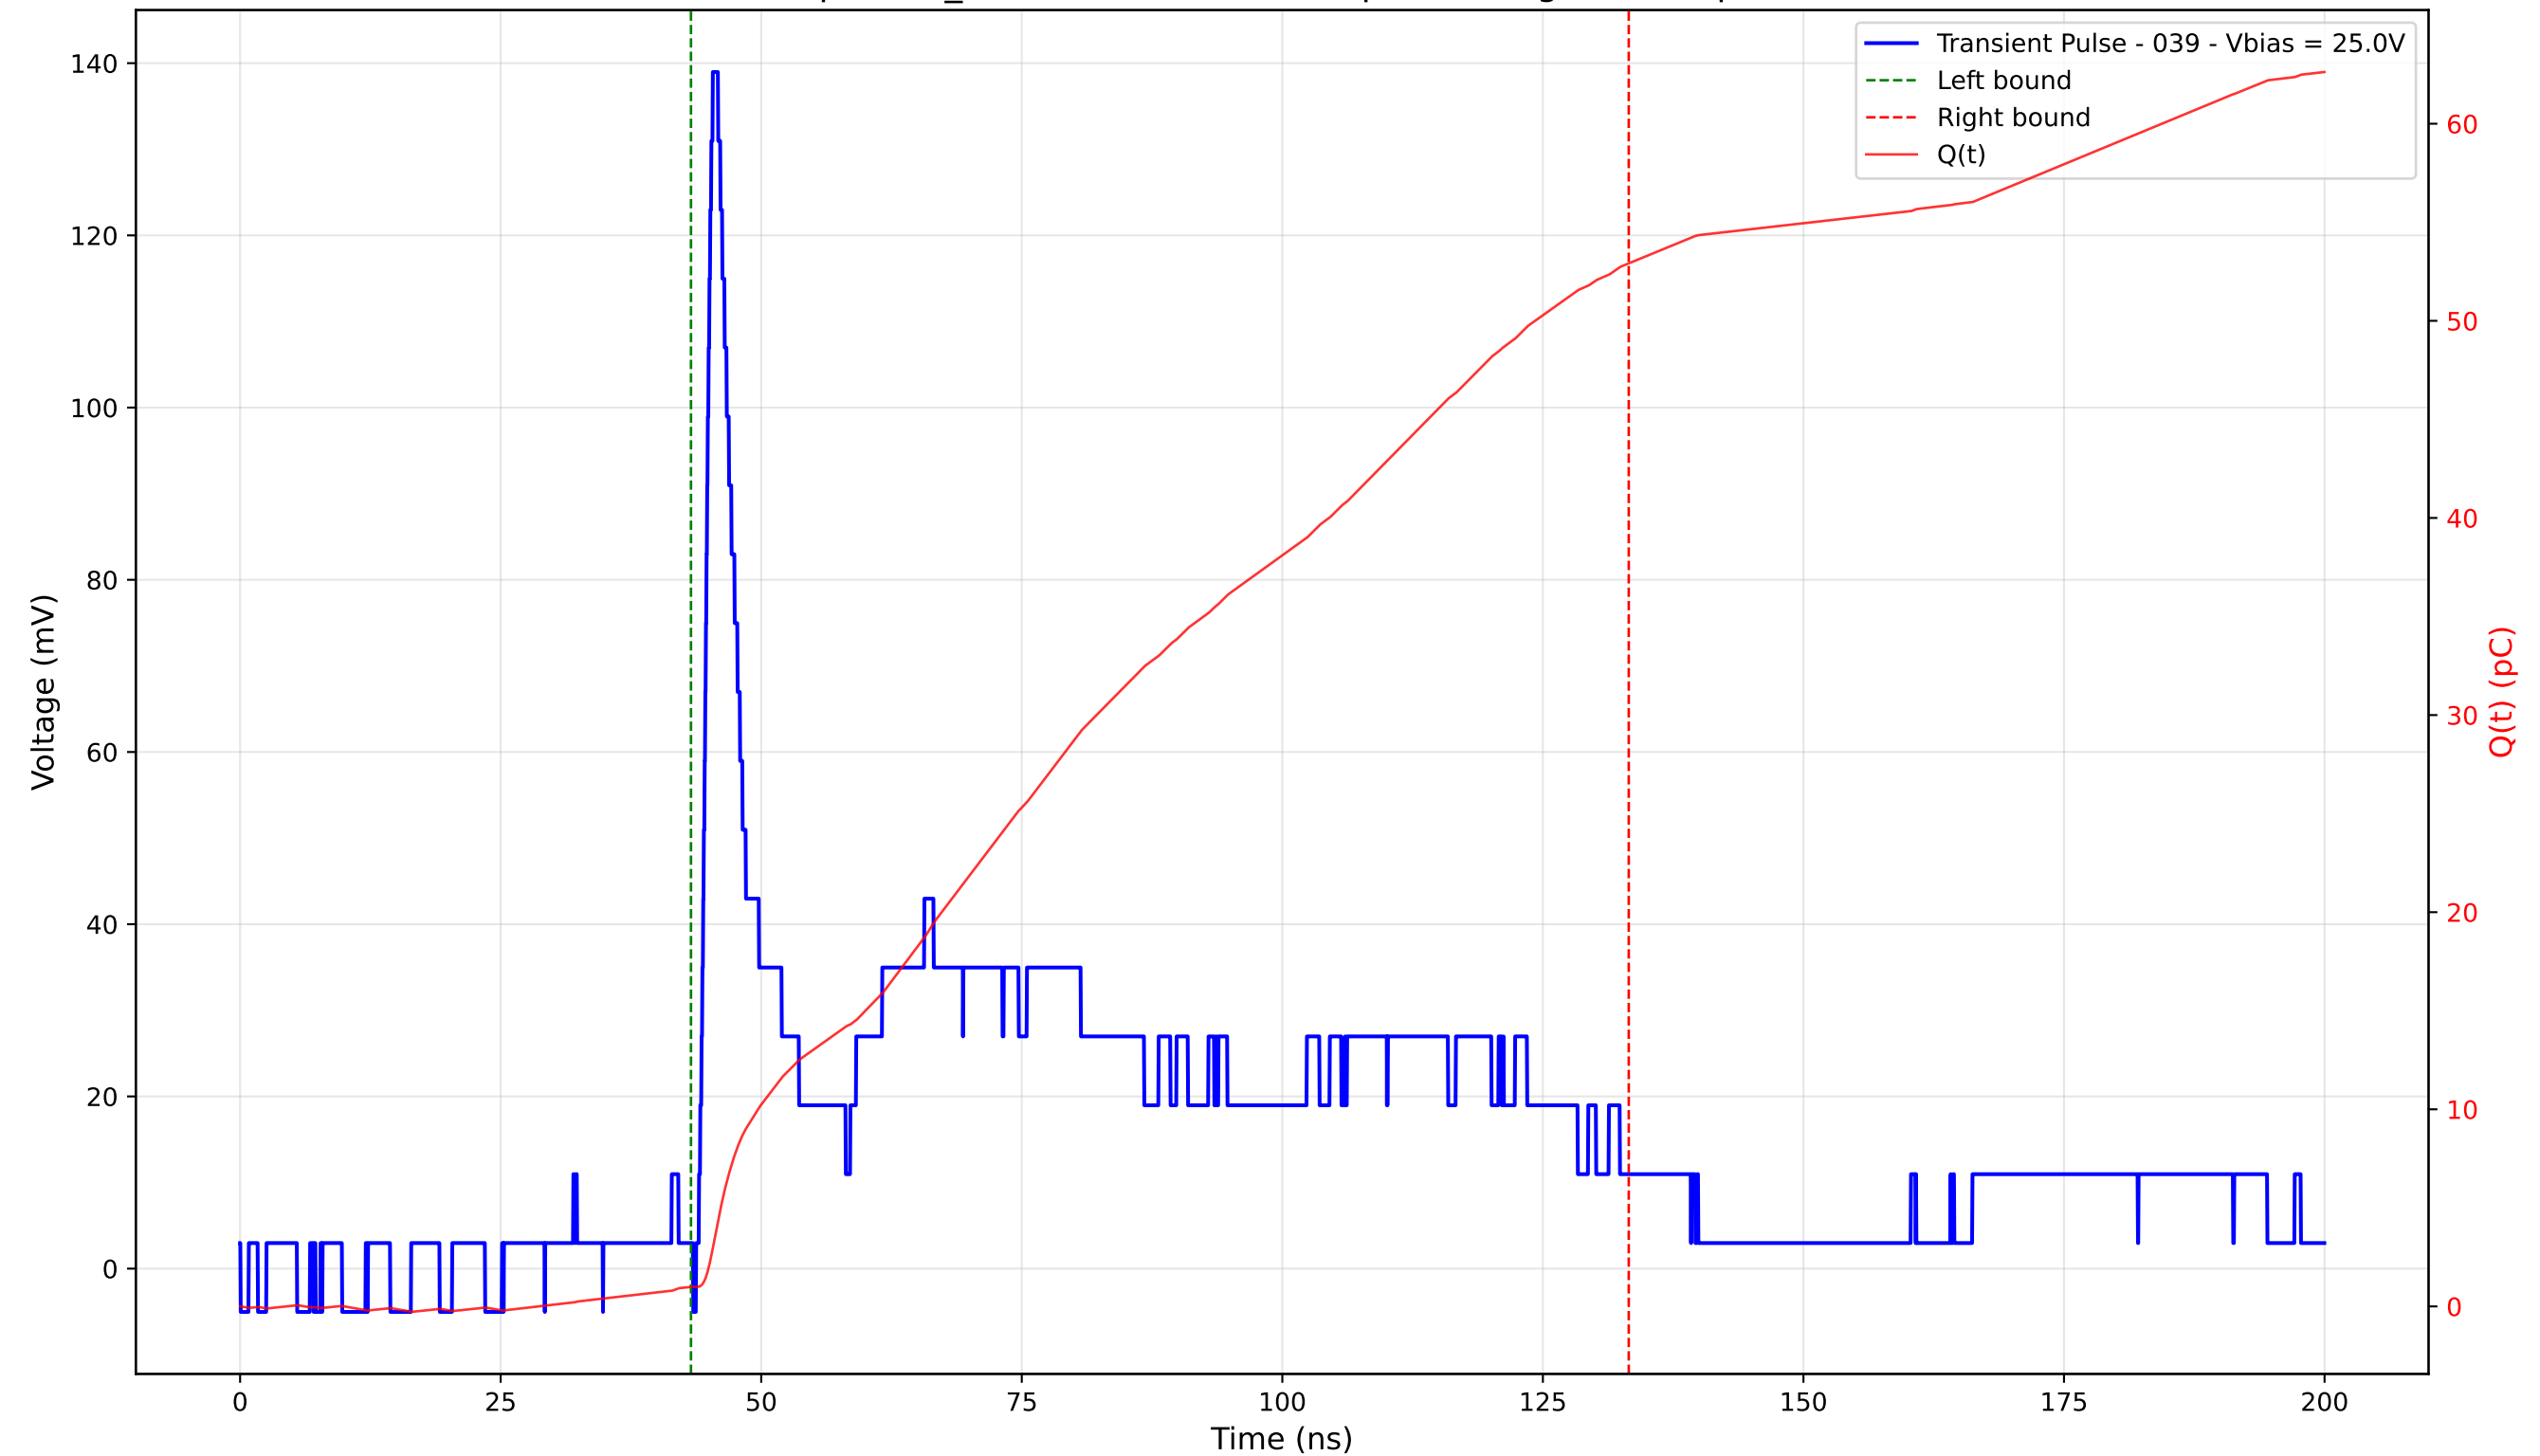


Transient Pulse - Sample: TD_4004 - Position: 250.0 μm - Charge: 50.34 pC - Rise Time: 1.01 ns

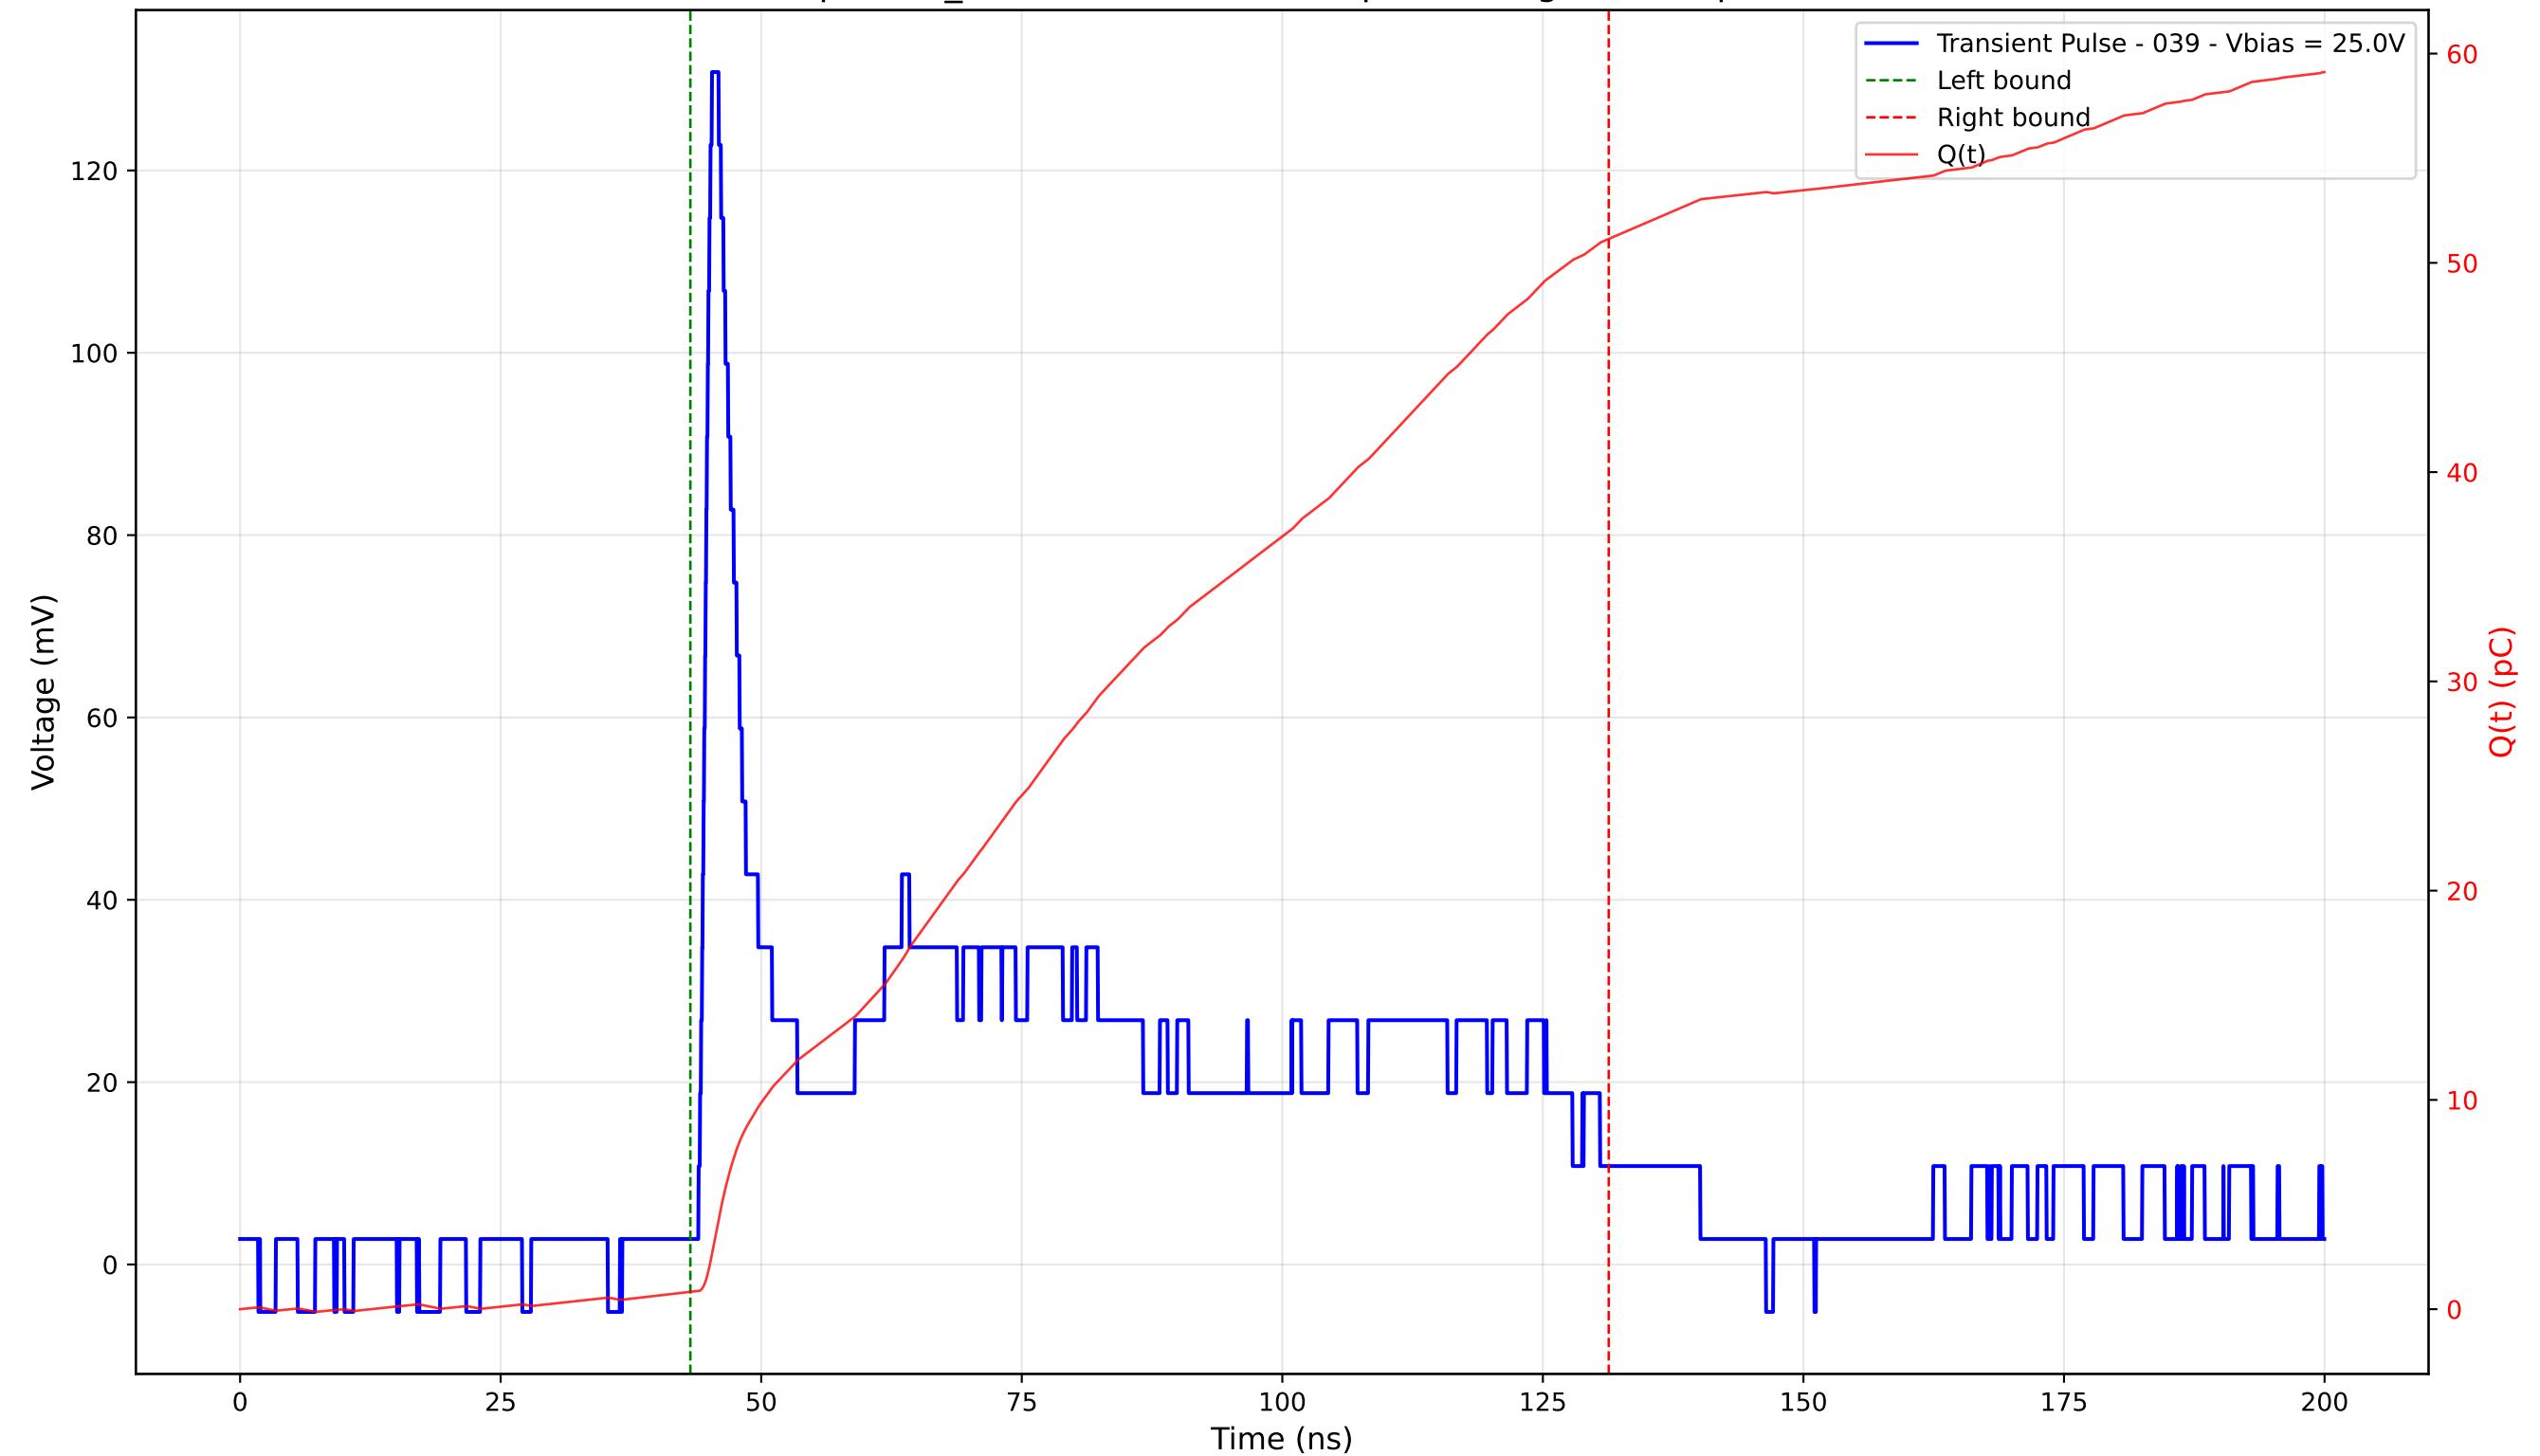


Transient Pulse - Sample: TD_4004 - Position: 255.0 μm - Charge: 47.10 pC - Rise Time: 1.05 ns

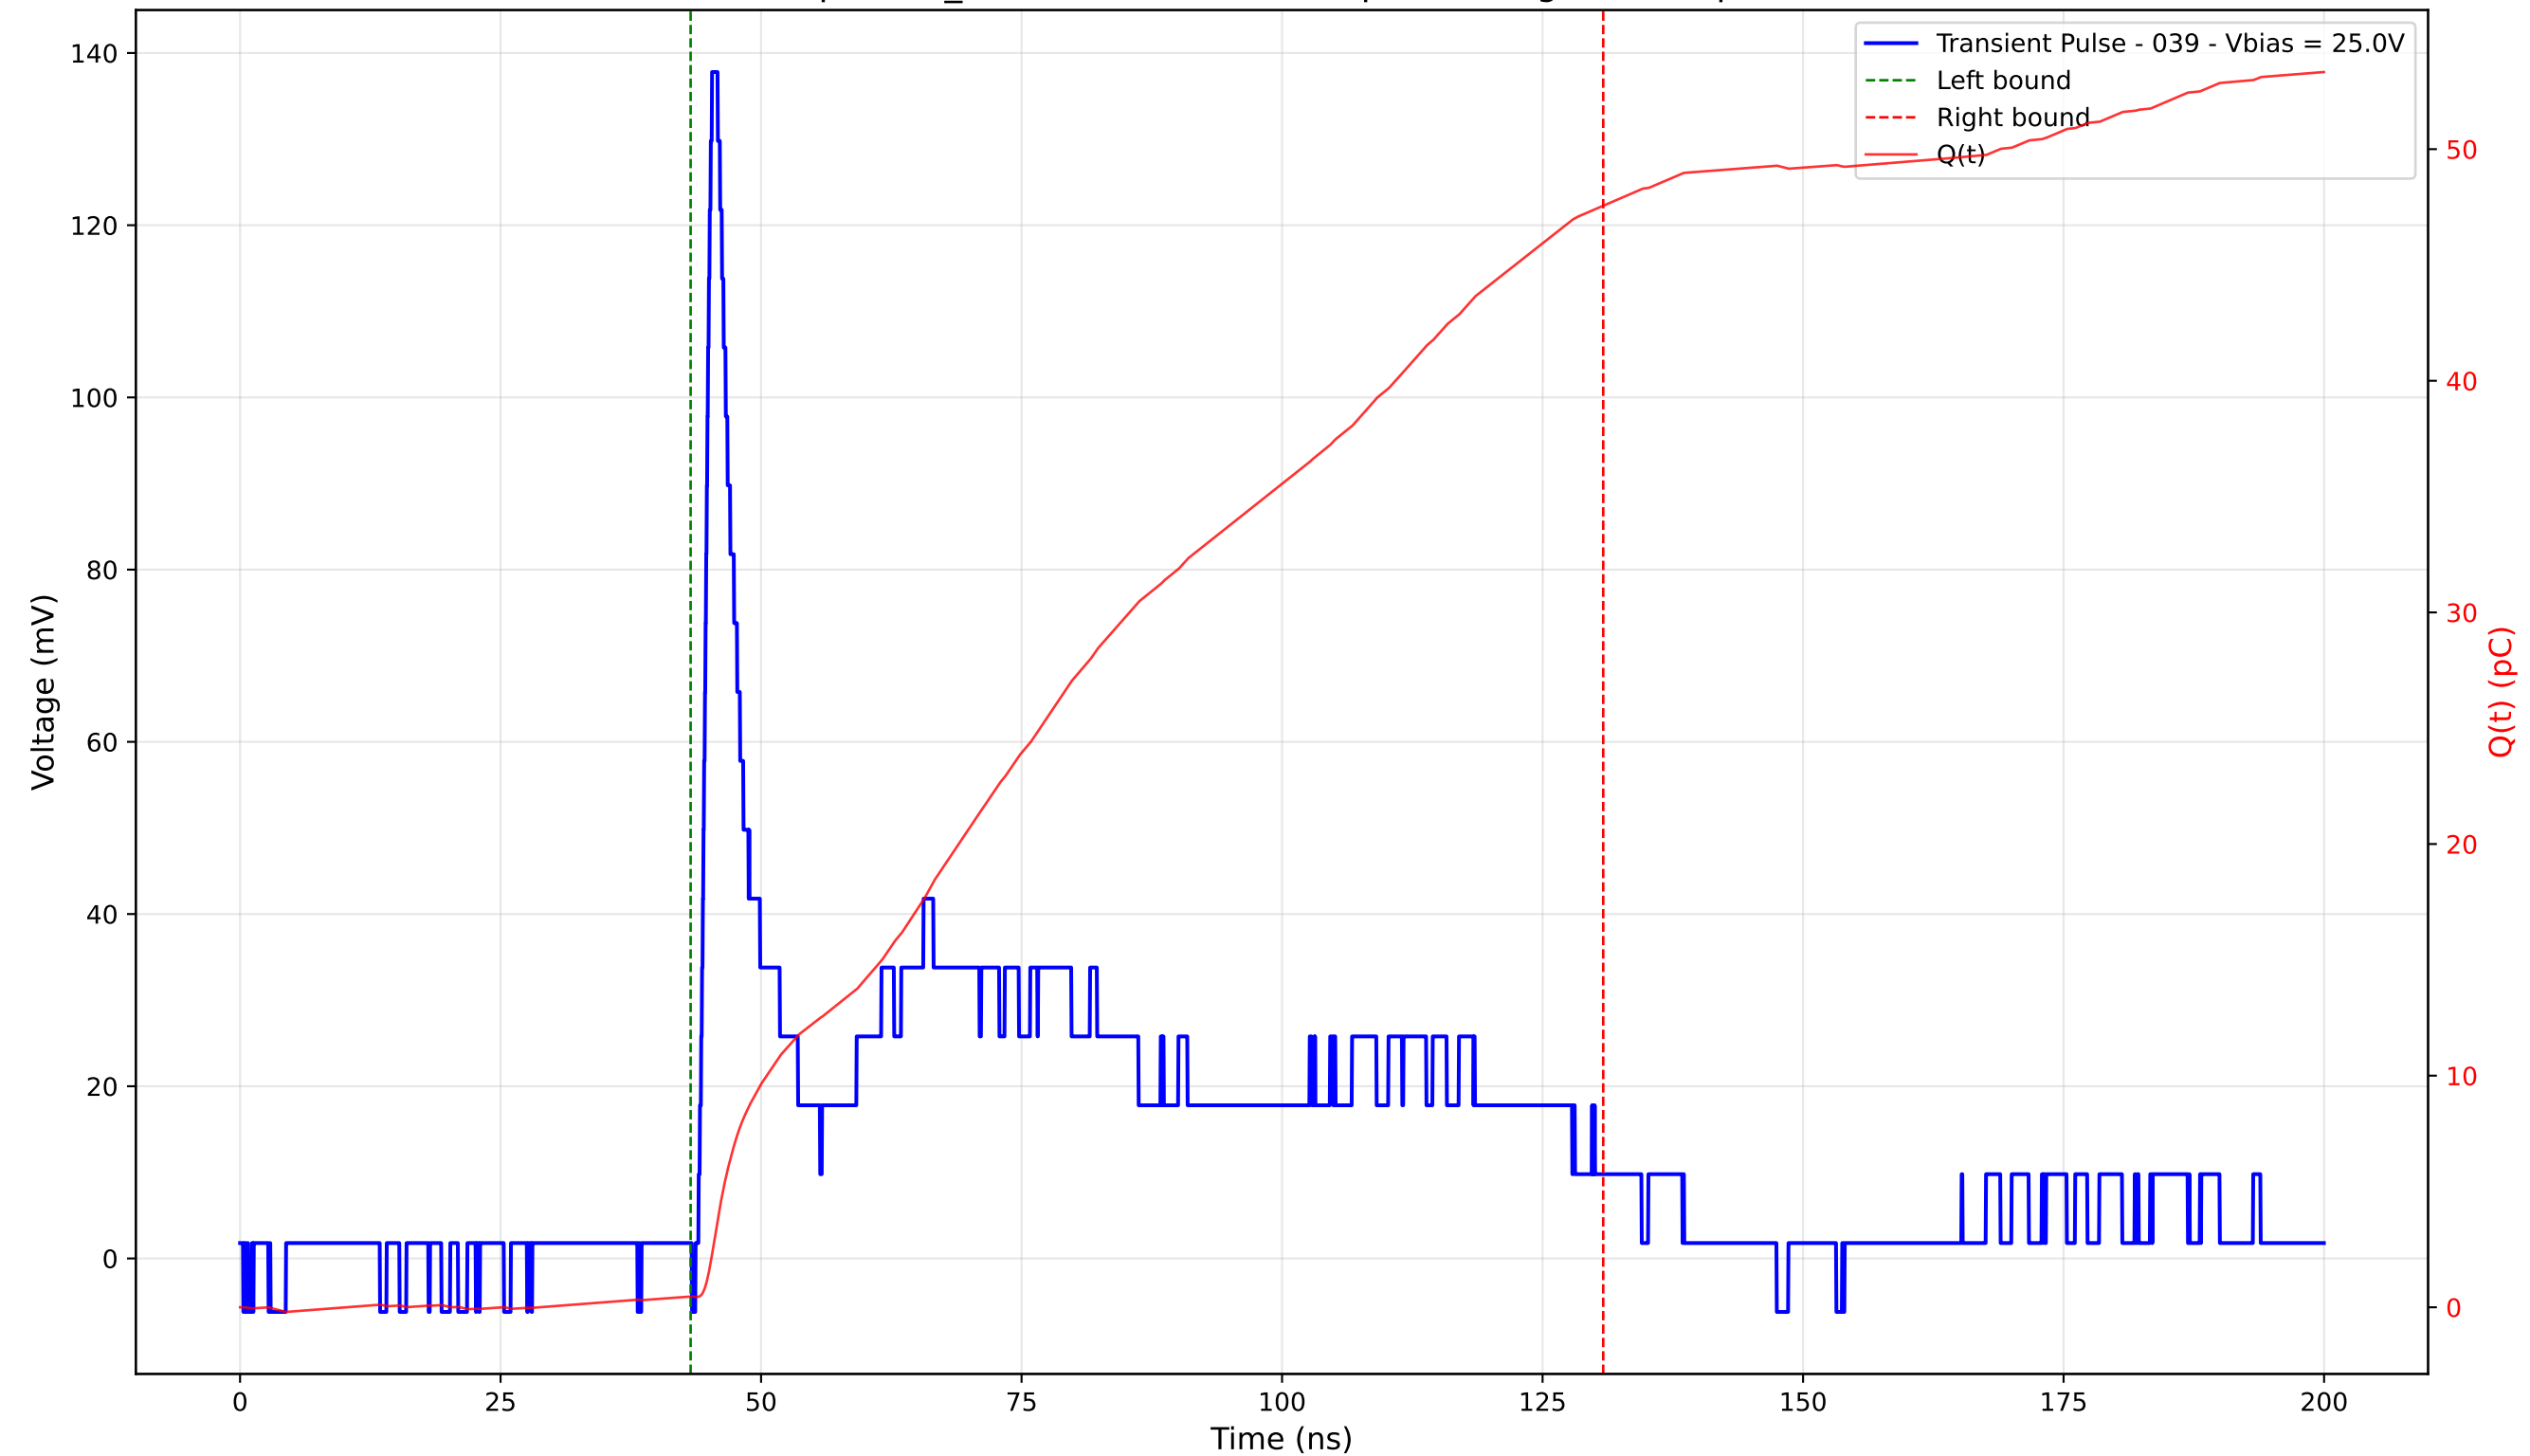


Transient Pulse - Sample: TD_4004 - Position: 260.0 μm - Charge: 47.07 pC - Rise Time: 1.11 ns

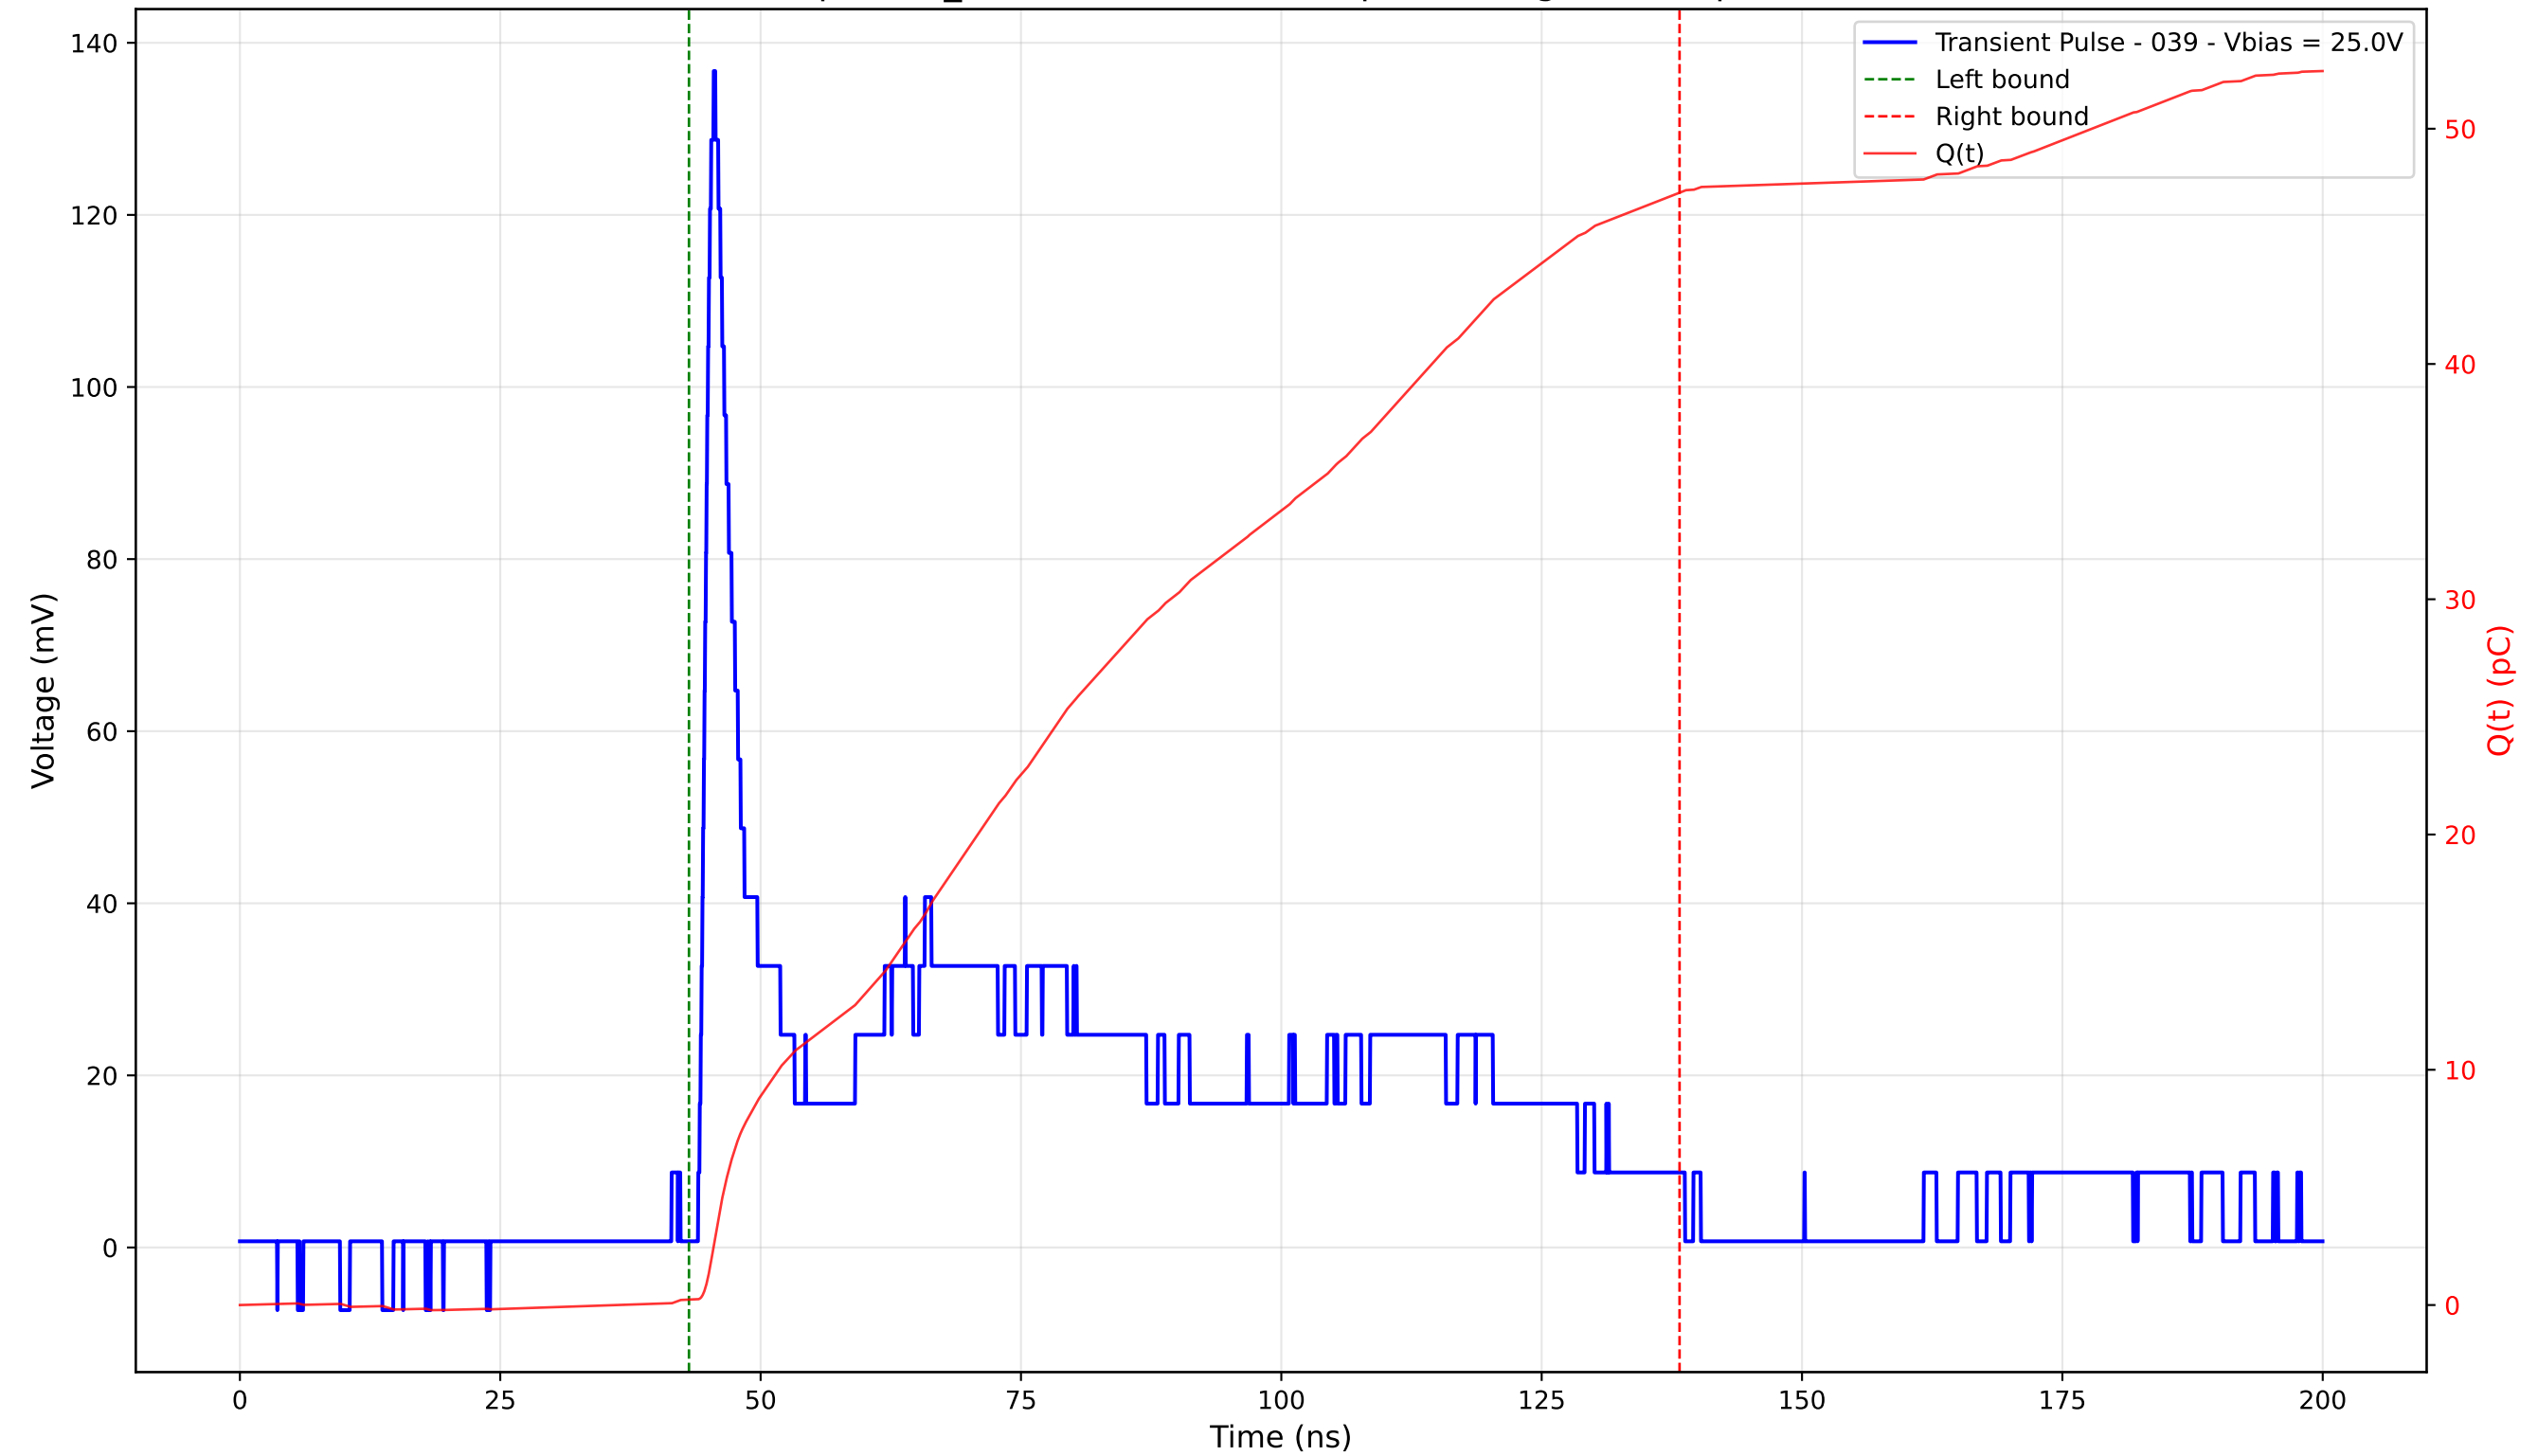


Transient Pulse - Sample: TD_4004 - Position: 265.0 μm - Charge: 35.06 pC - Rise Time: 1.09 ns

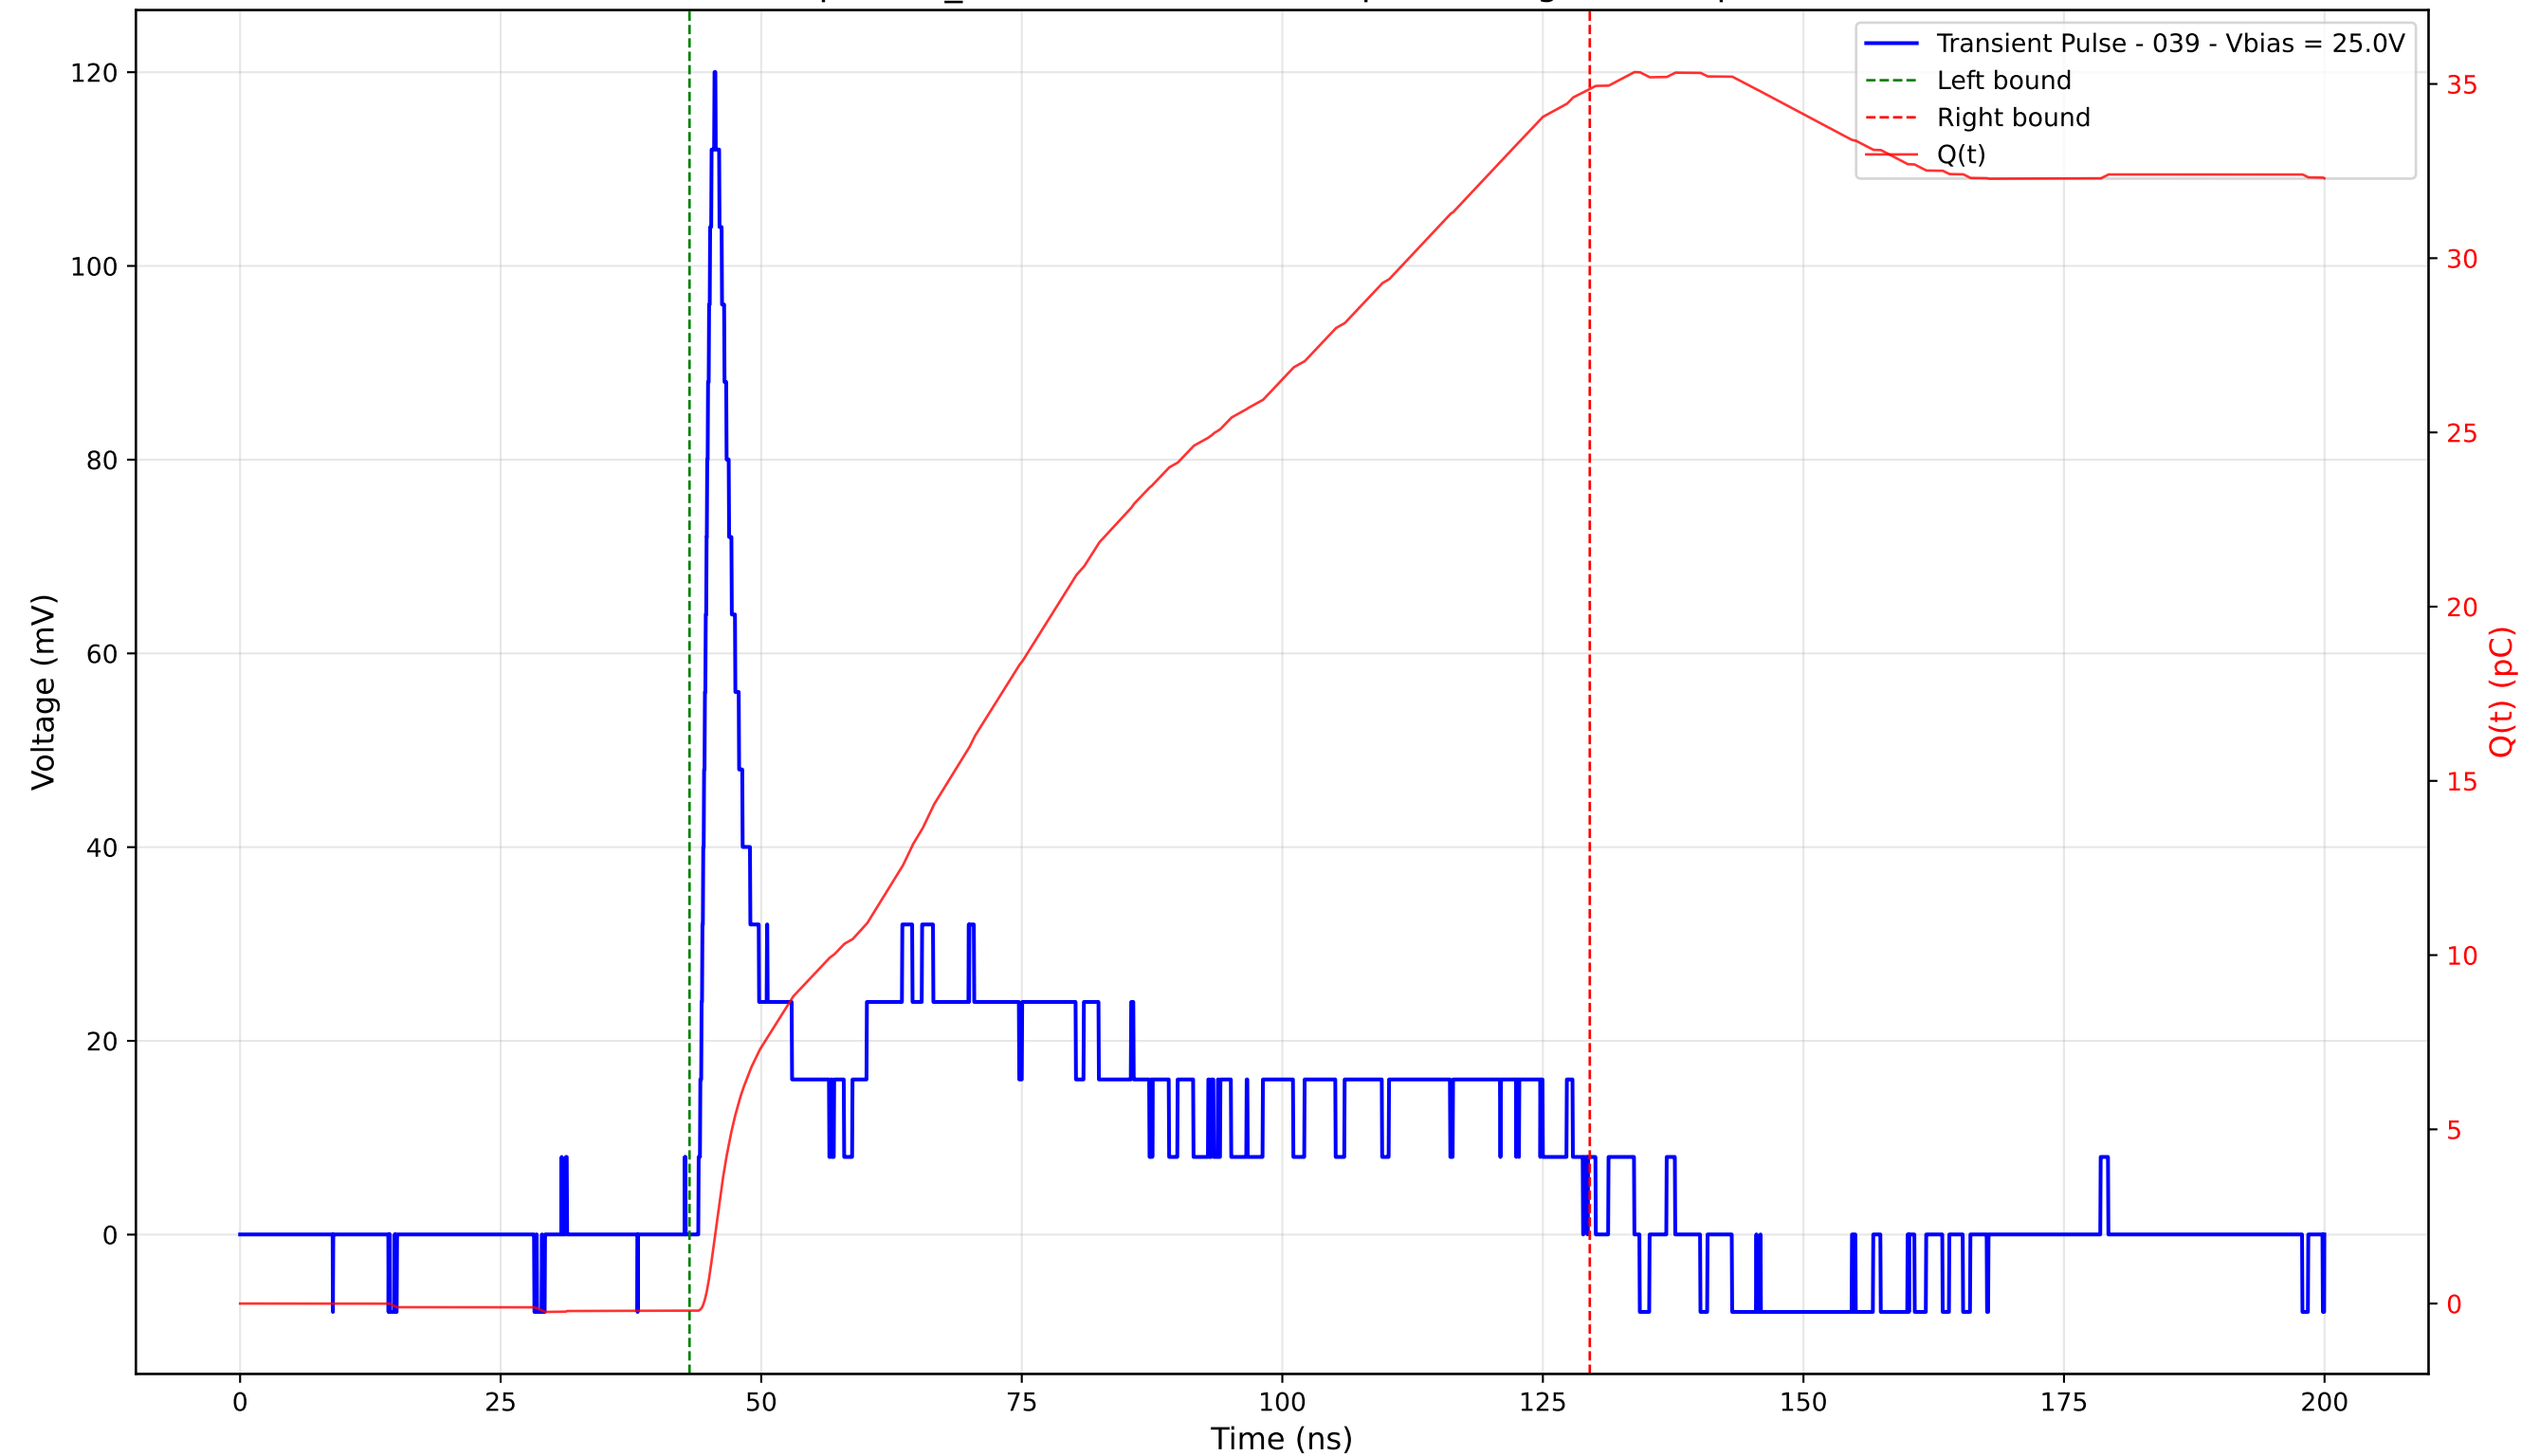


Transient Pulse - Sample: TD_4004 - Position: 270.0 μm - Charge: 42.70 pC - Rise Time: 1.12 ns

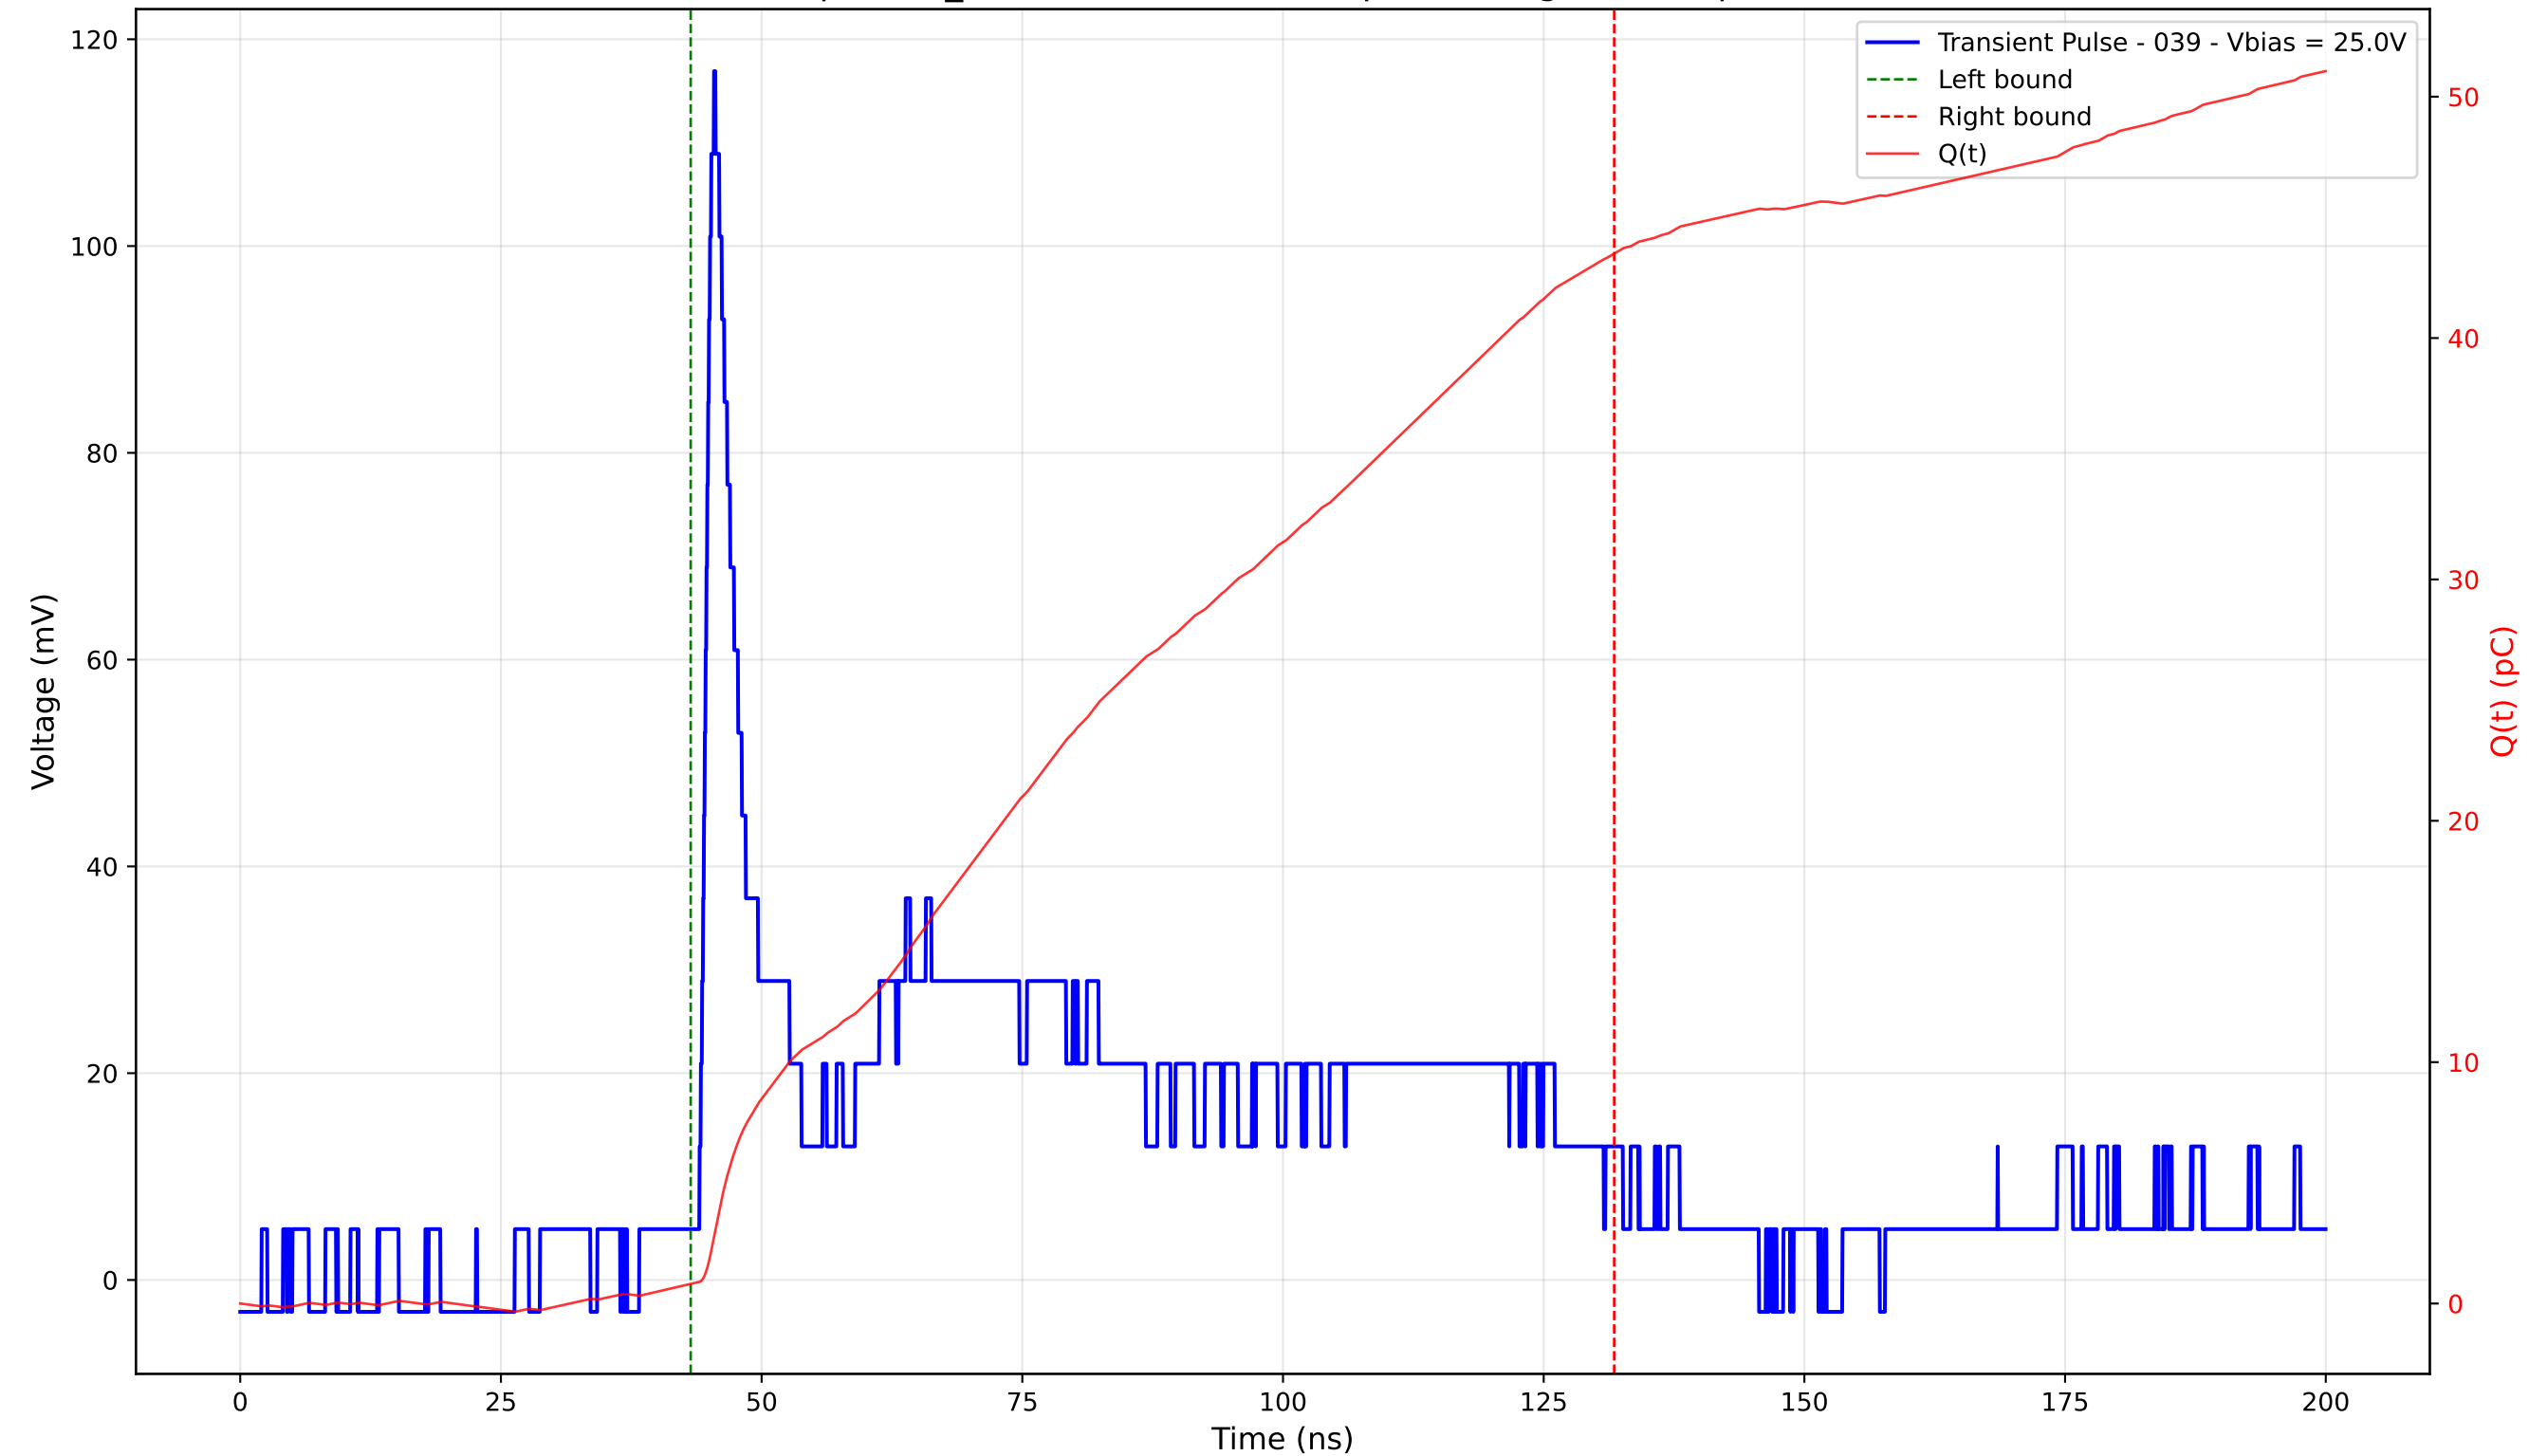


Transient Pulse - Sample: TD_4004 - Position: 275.0 μm - Charge: 38.96 pC - Rise Time: 0.99 ns

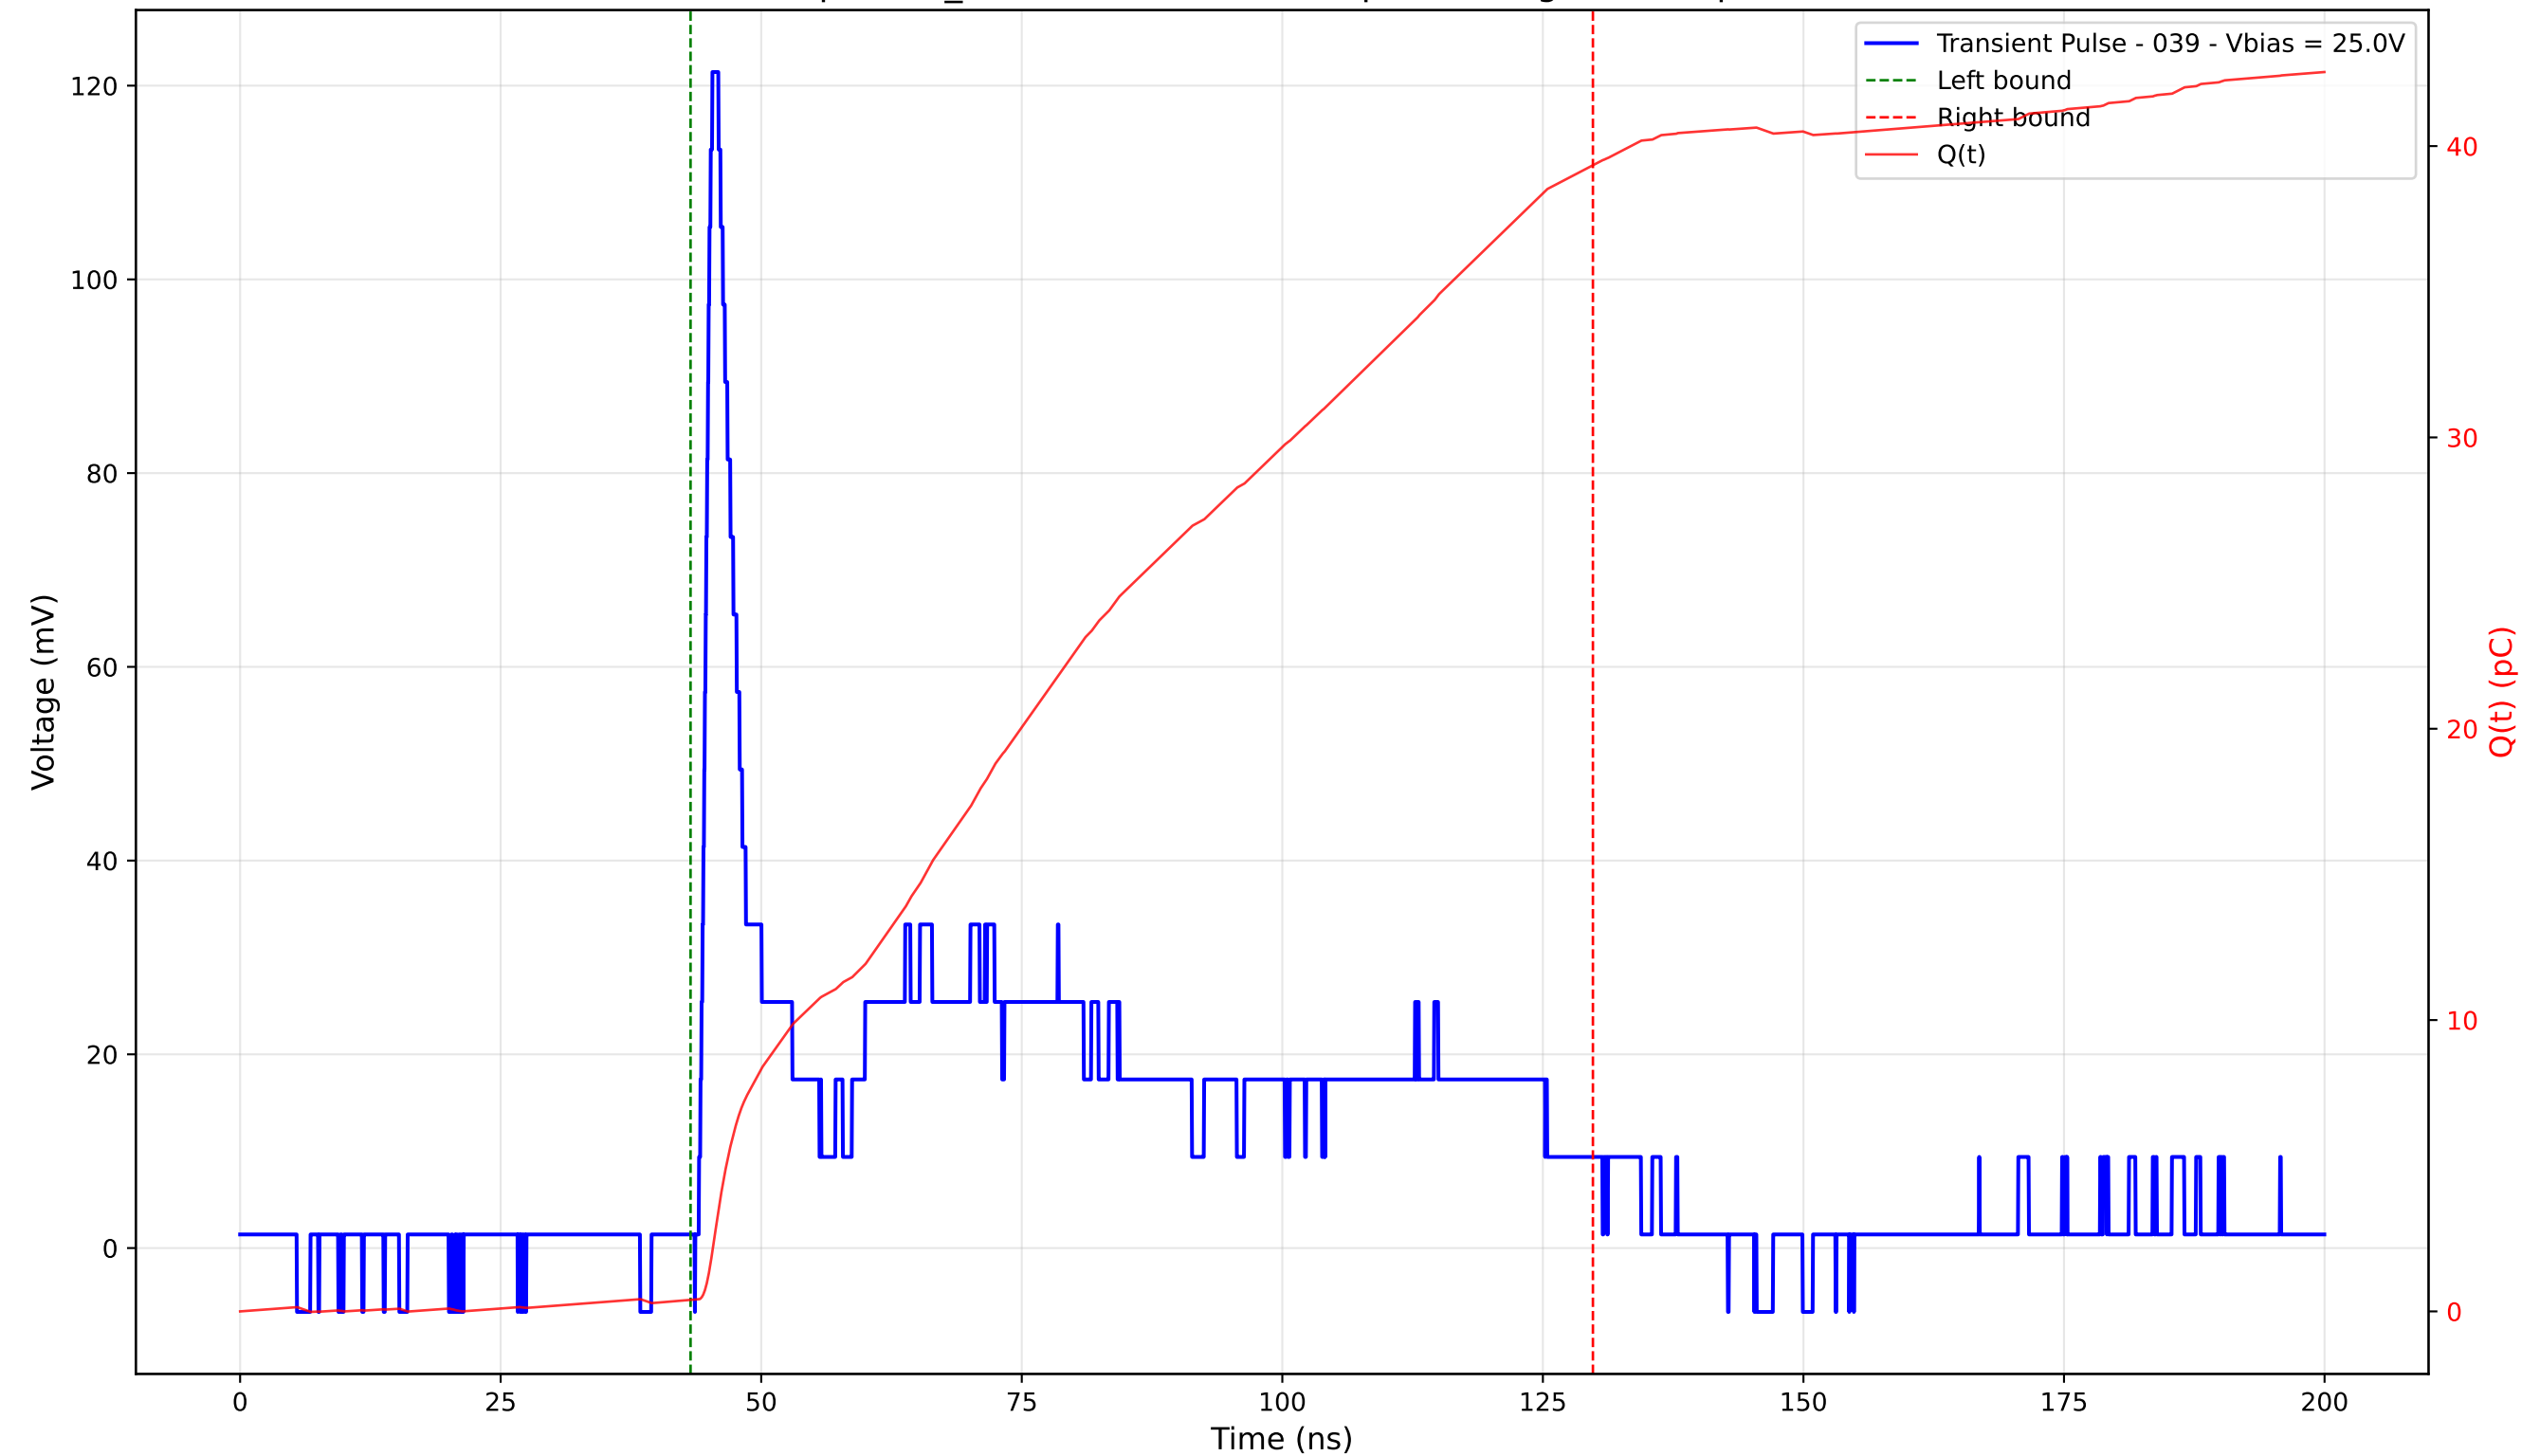


Transient Pulse - Sample: TD_4004 - Position: 280.0 μm - Charge: 44.64 pC - Rise Time: 1.11 ns

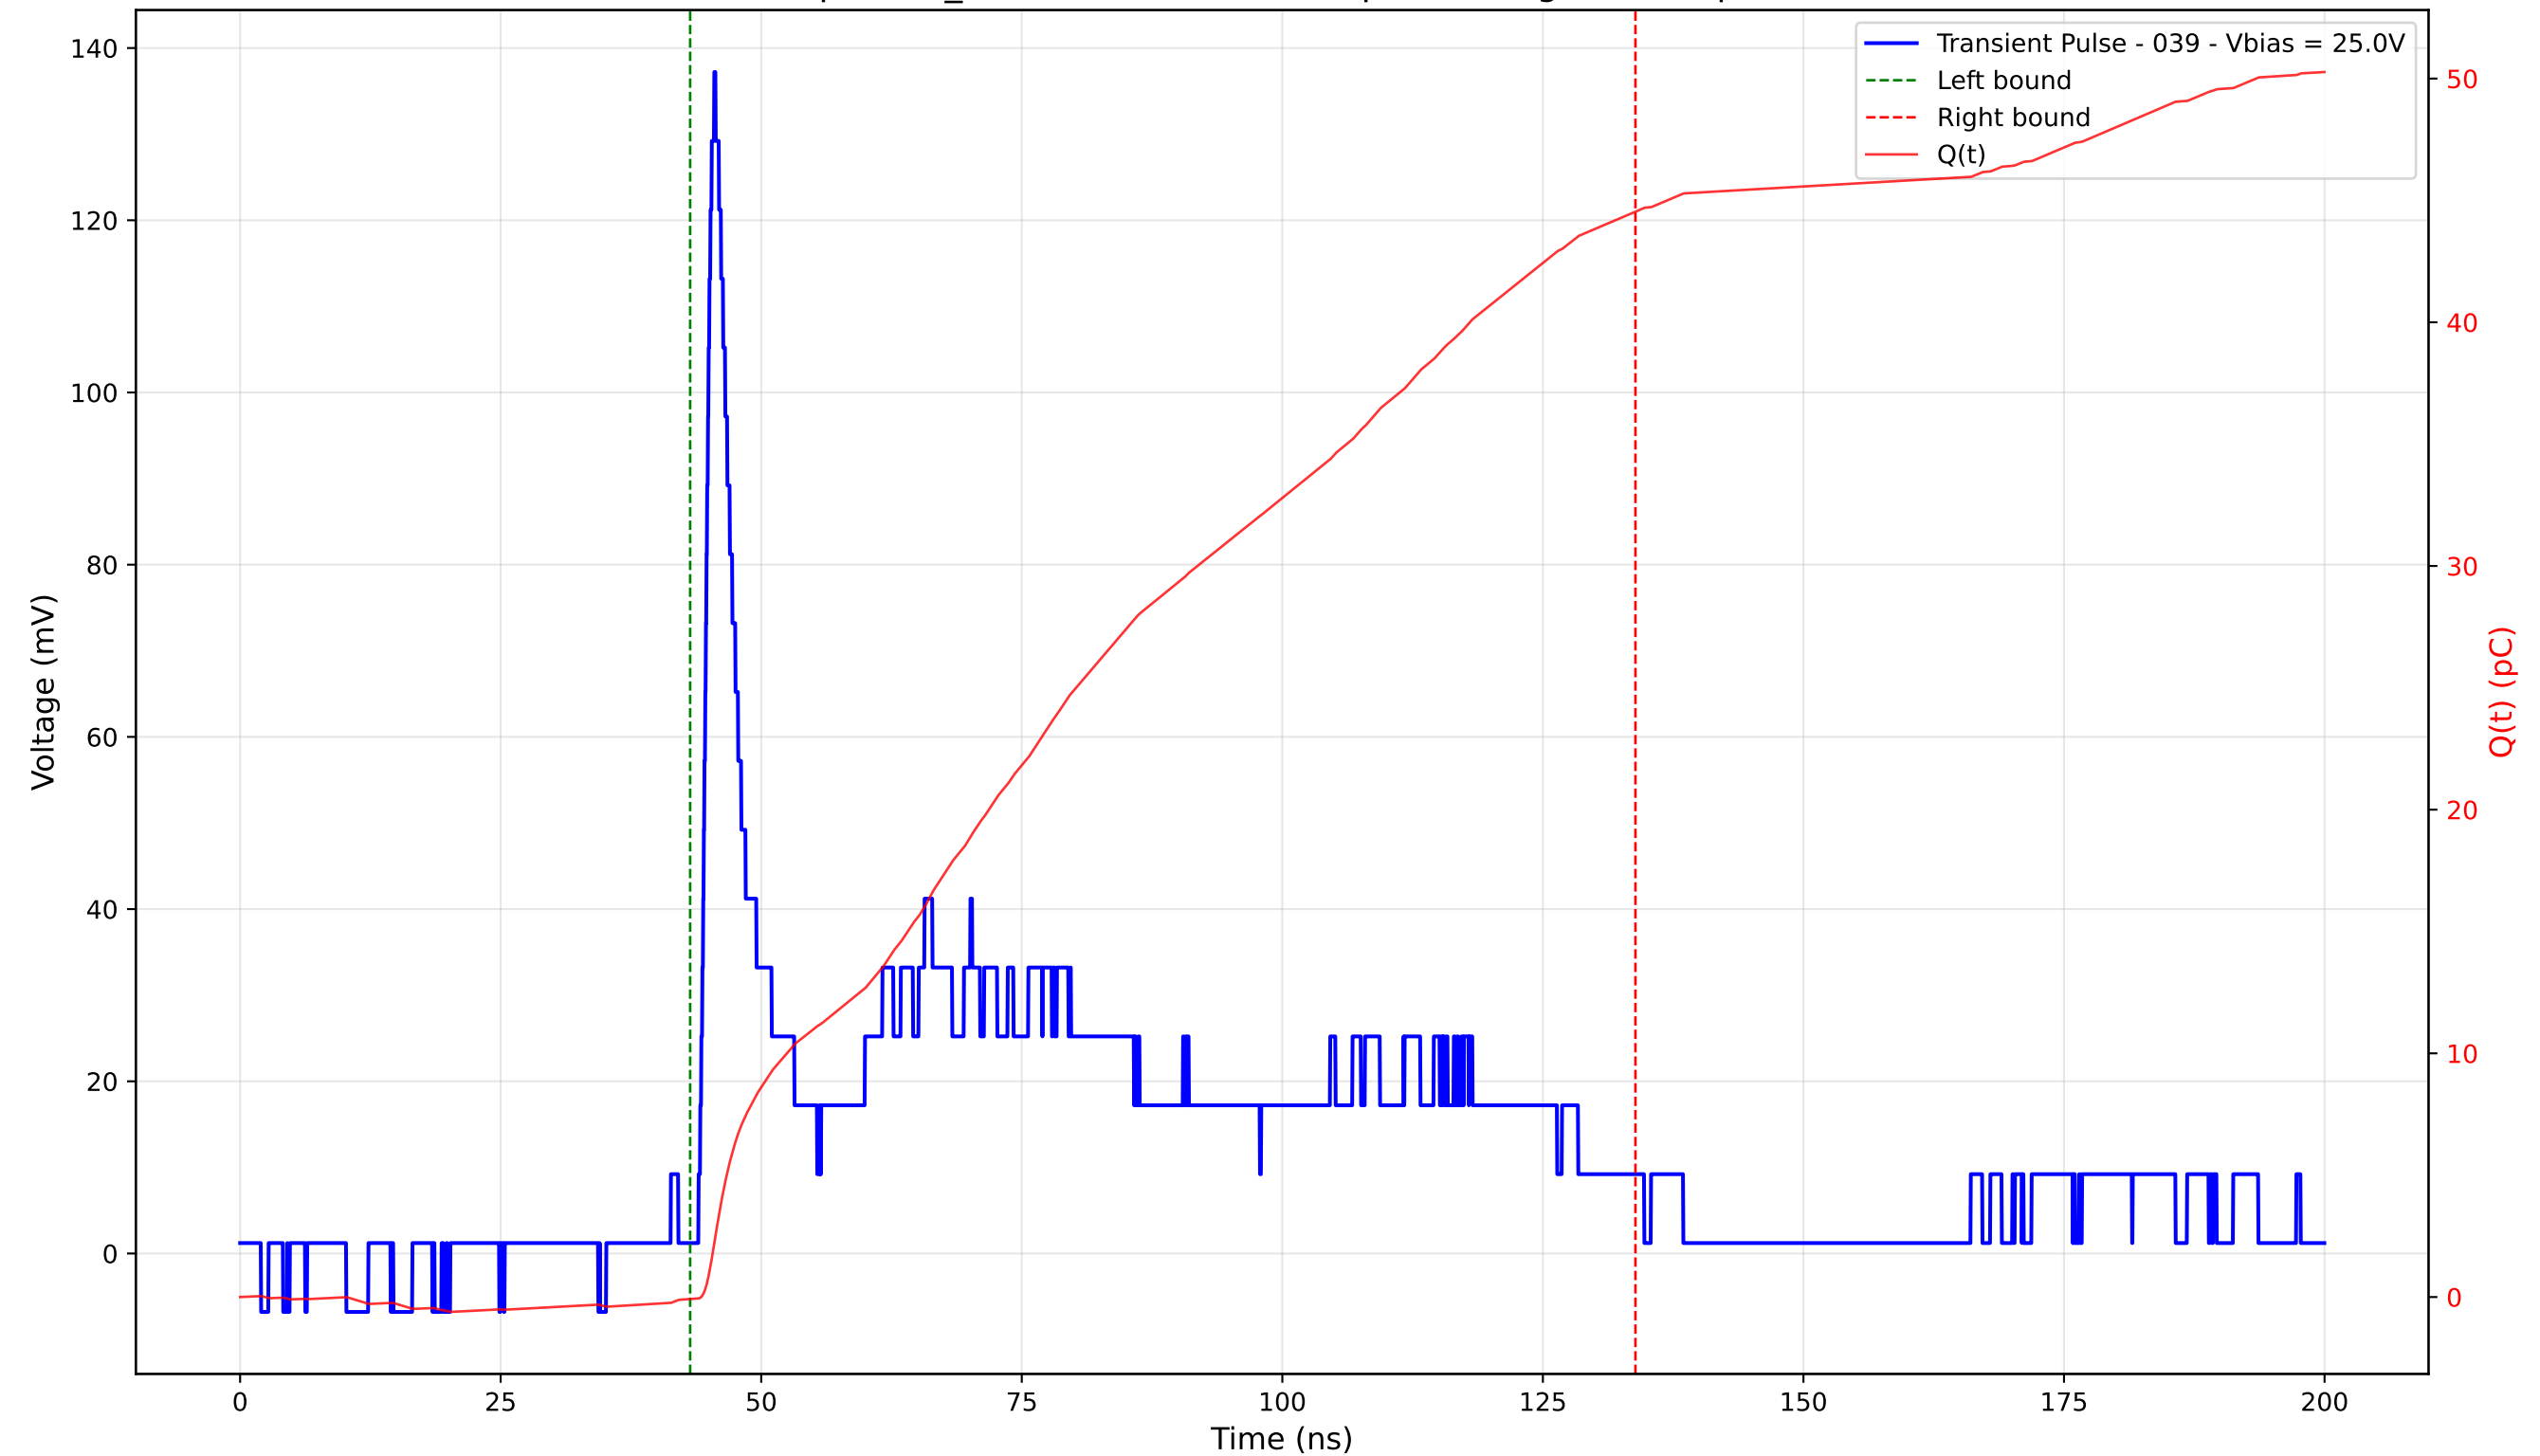


Transient Pulse - Sample: TD_4004 - Position: 285.0 μm - Charge: 51.06 pC - Rise Time: 1.06 ns

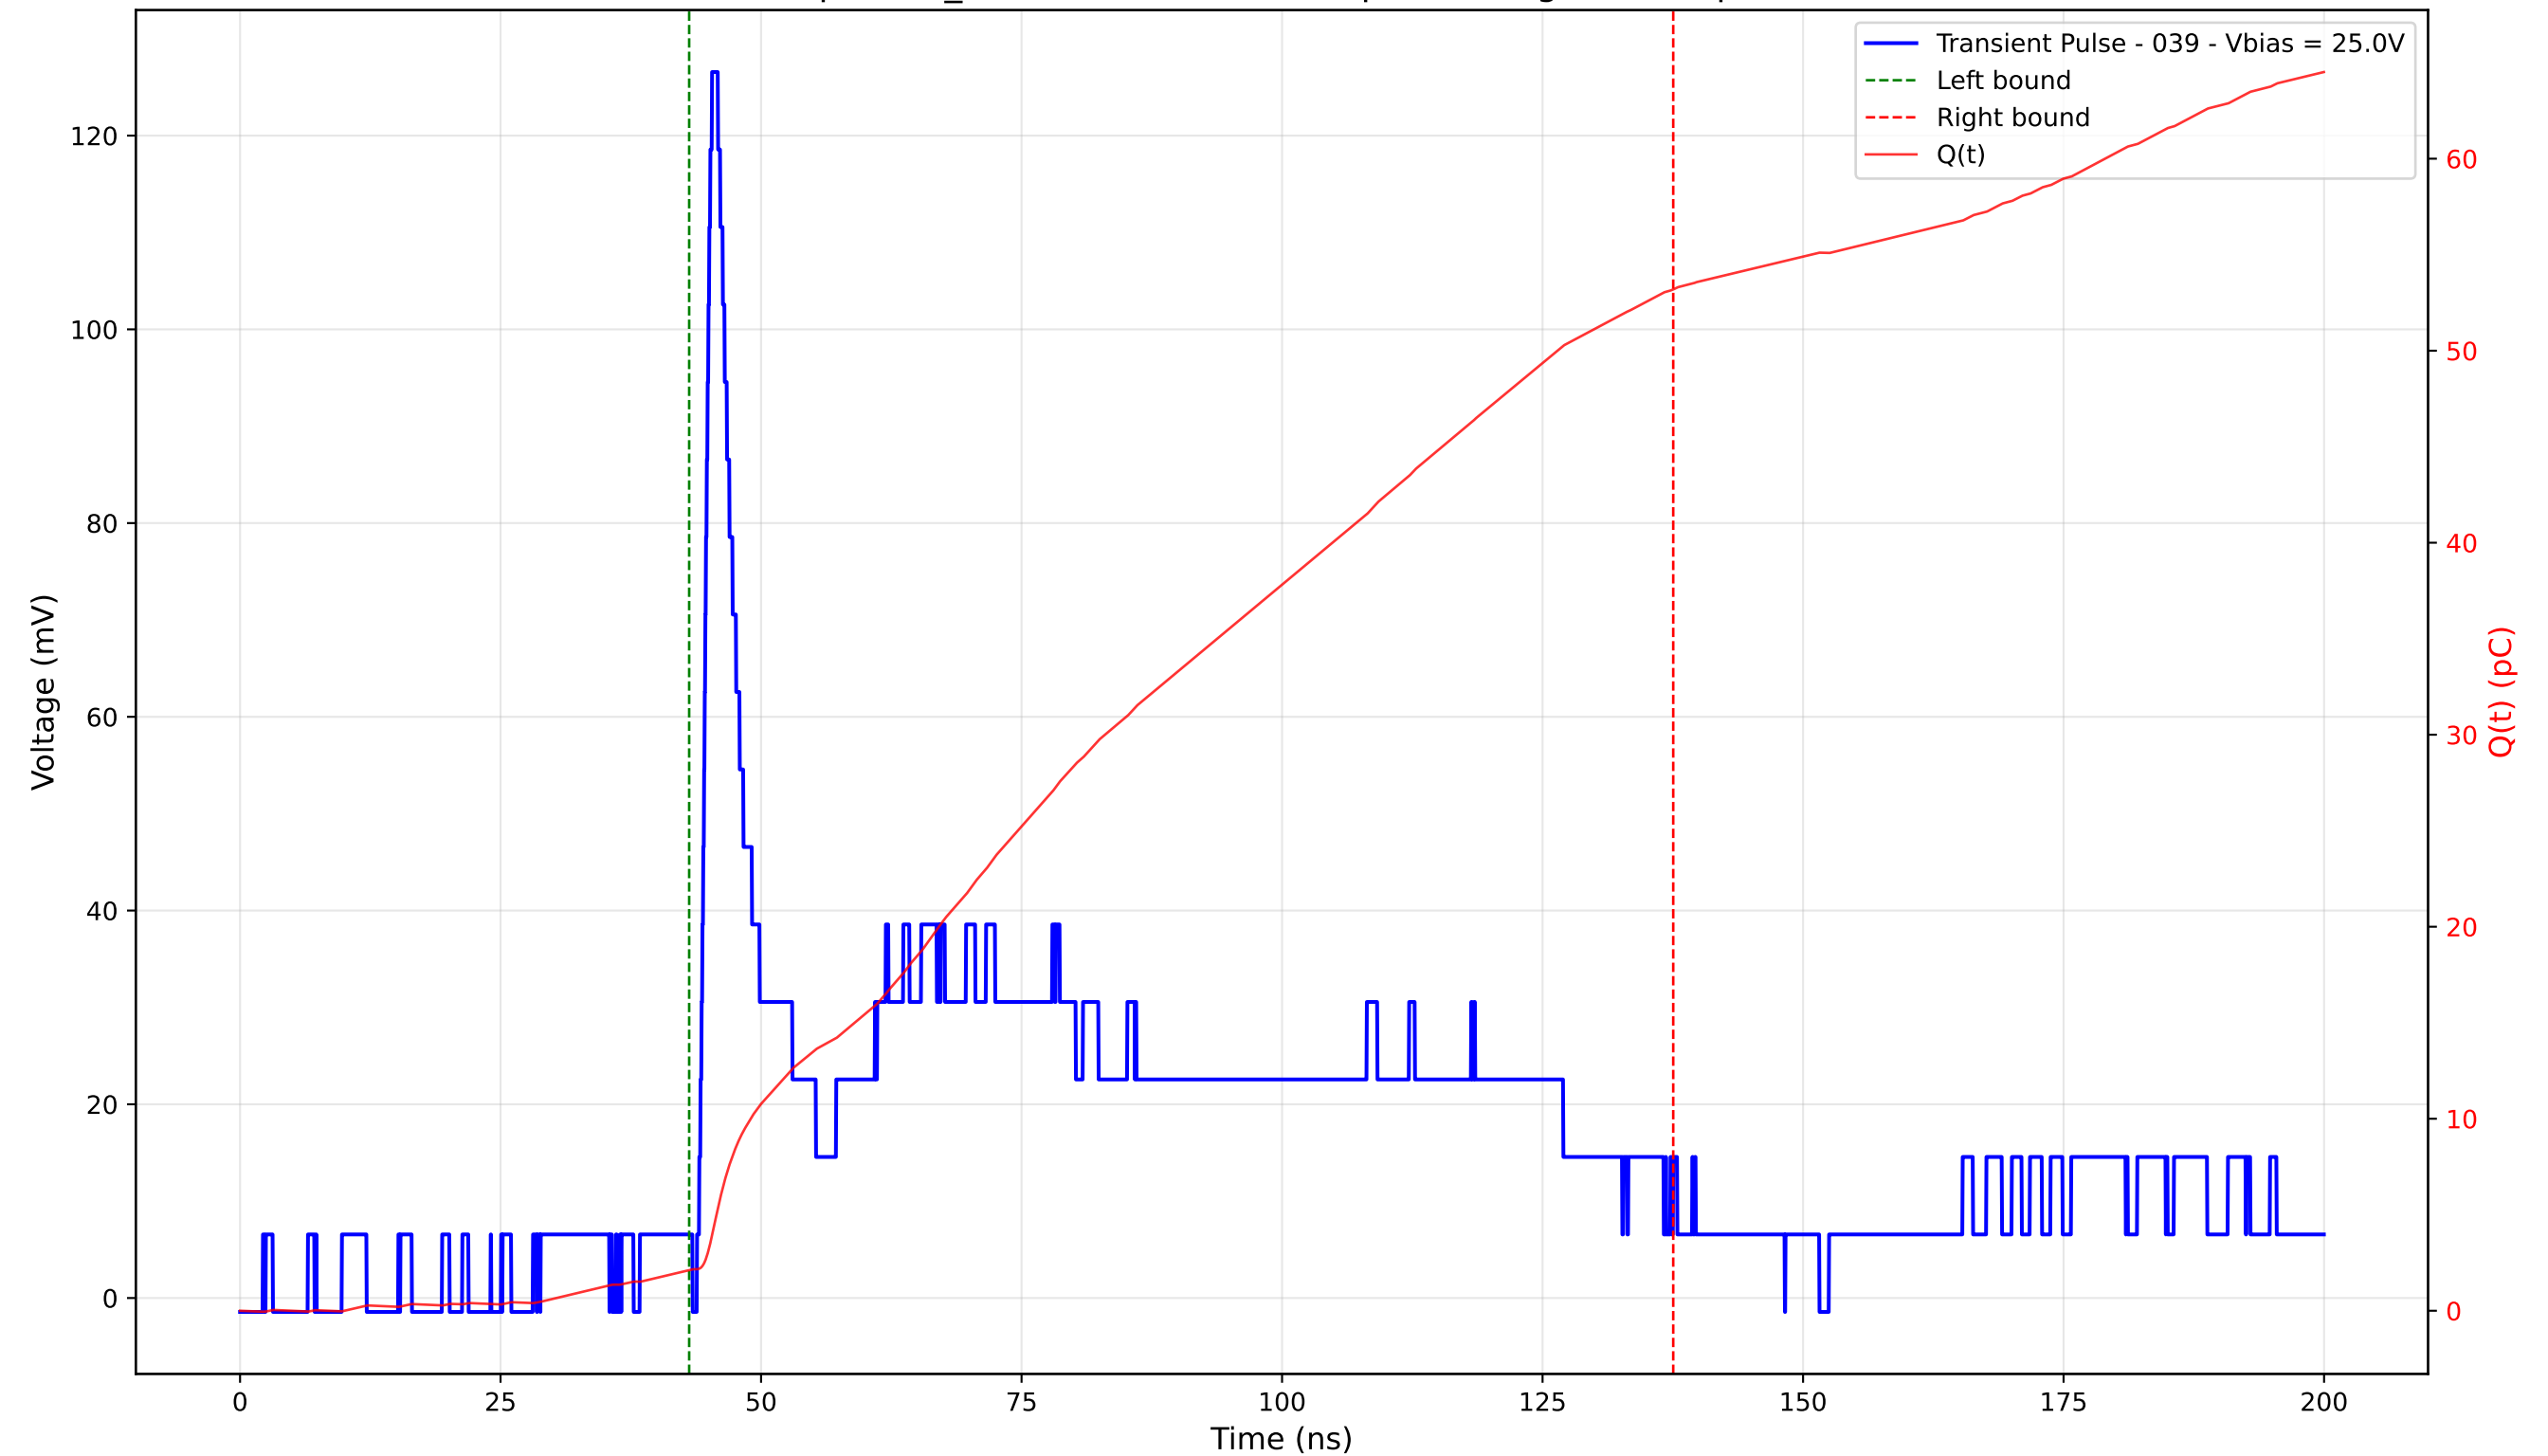


Transient Pulse - Sample: TD_4004 - Position: 290.0 μm - Charge: 32.26 pC - Rise Time: 0.94 ns

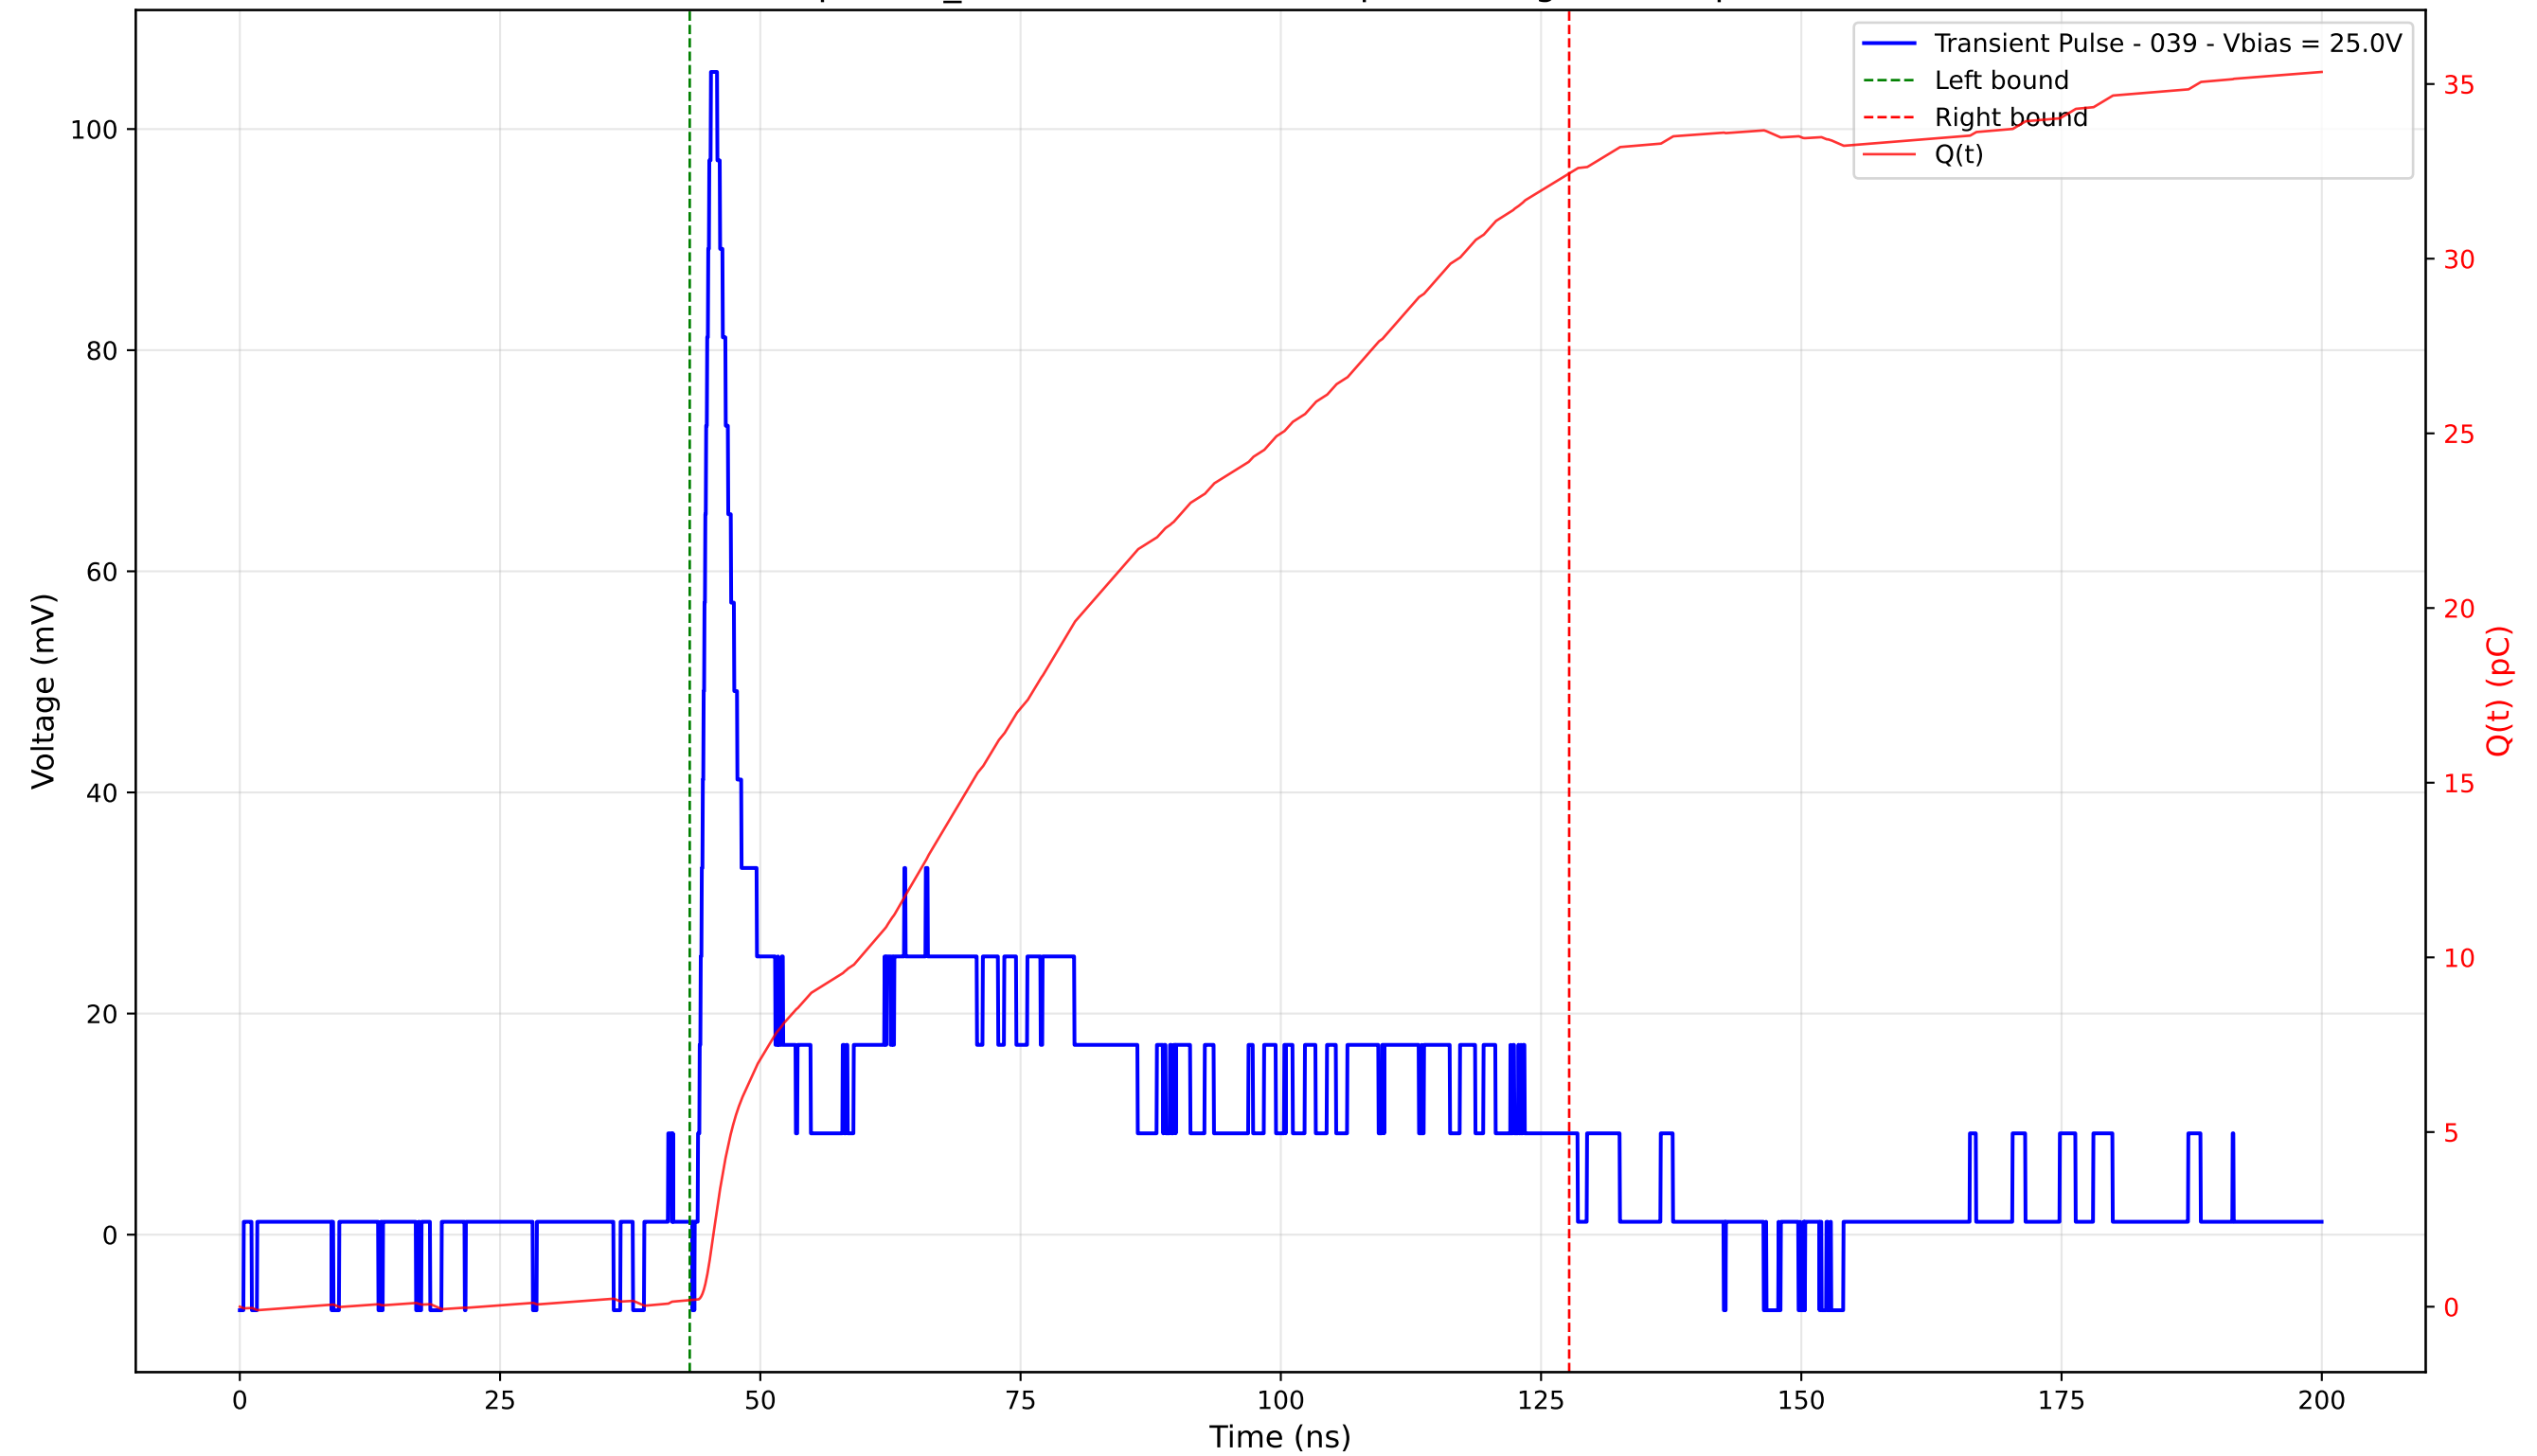


Transient Pulse - Sample: TD_4004 - Position: 295.0 μm - Charge: 36.56 pC - Rise Time: 1.21 ns

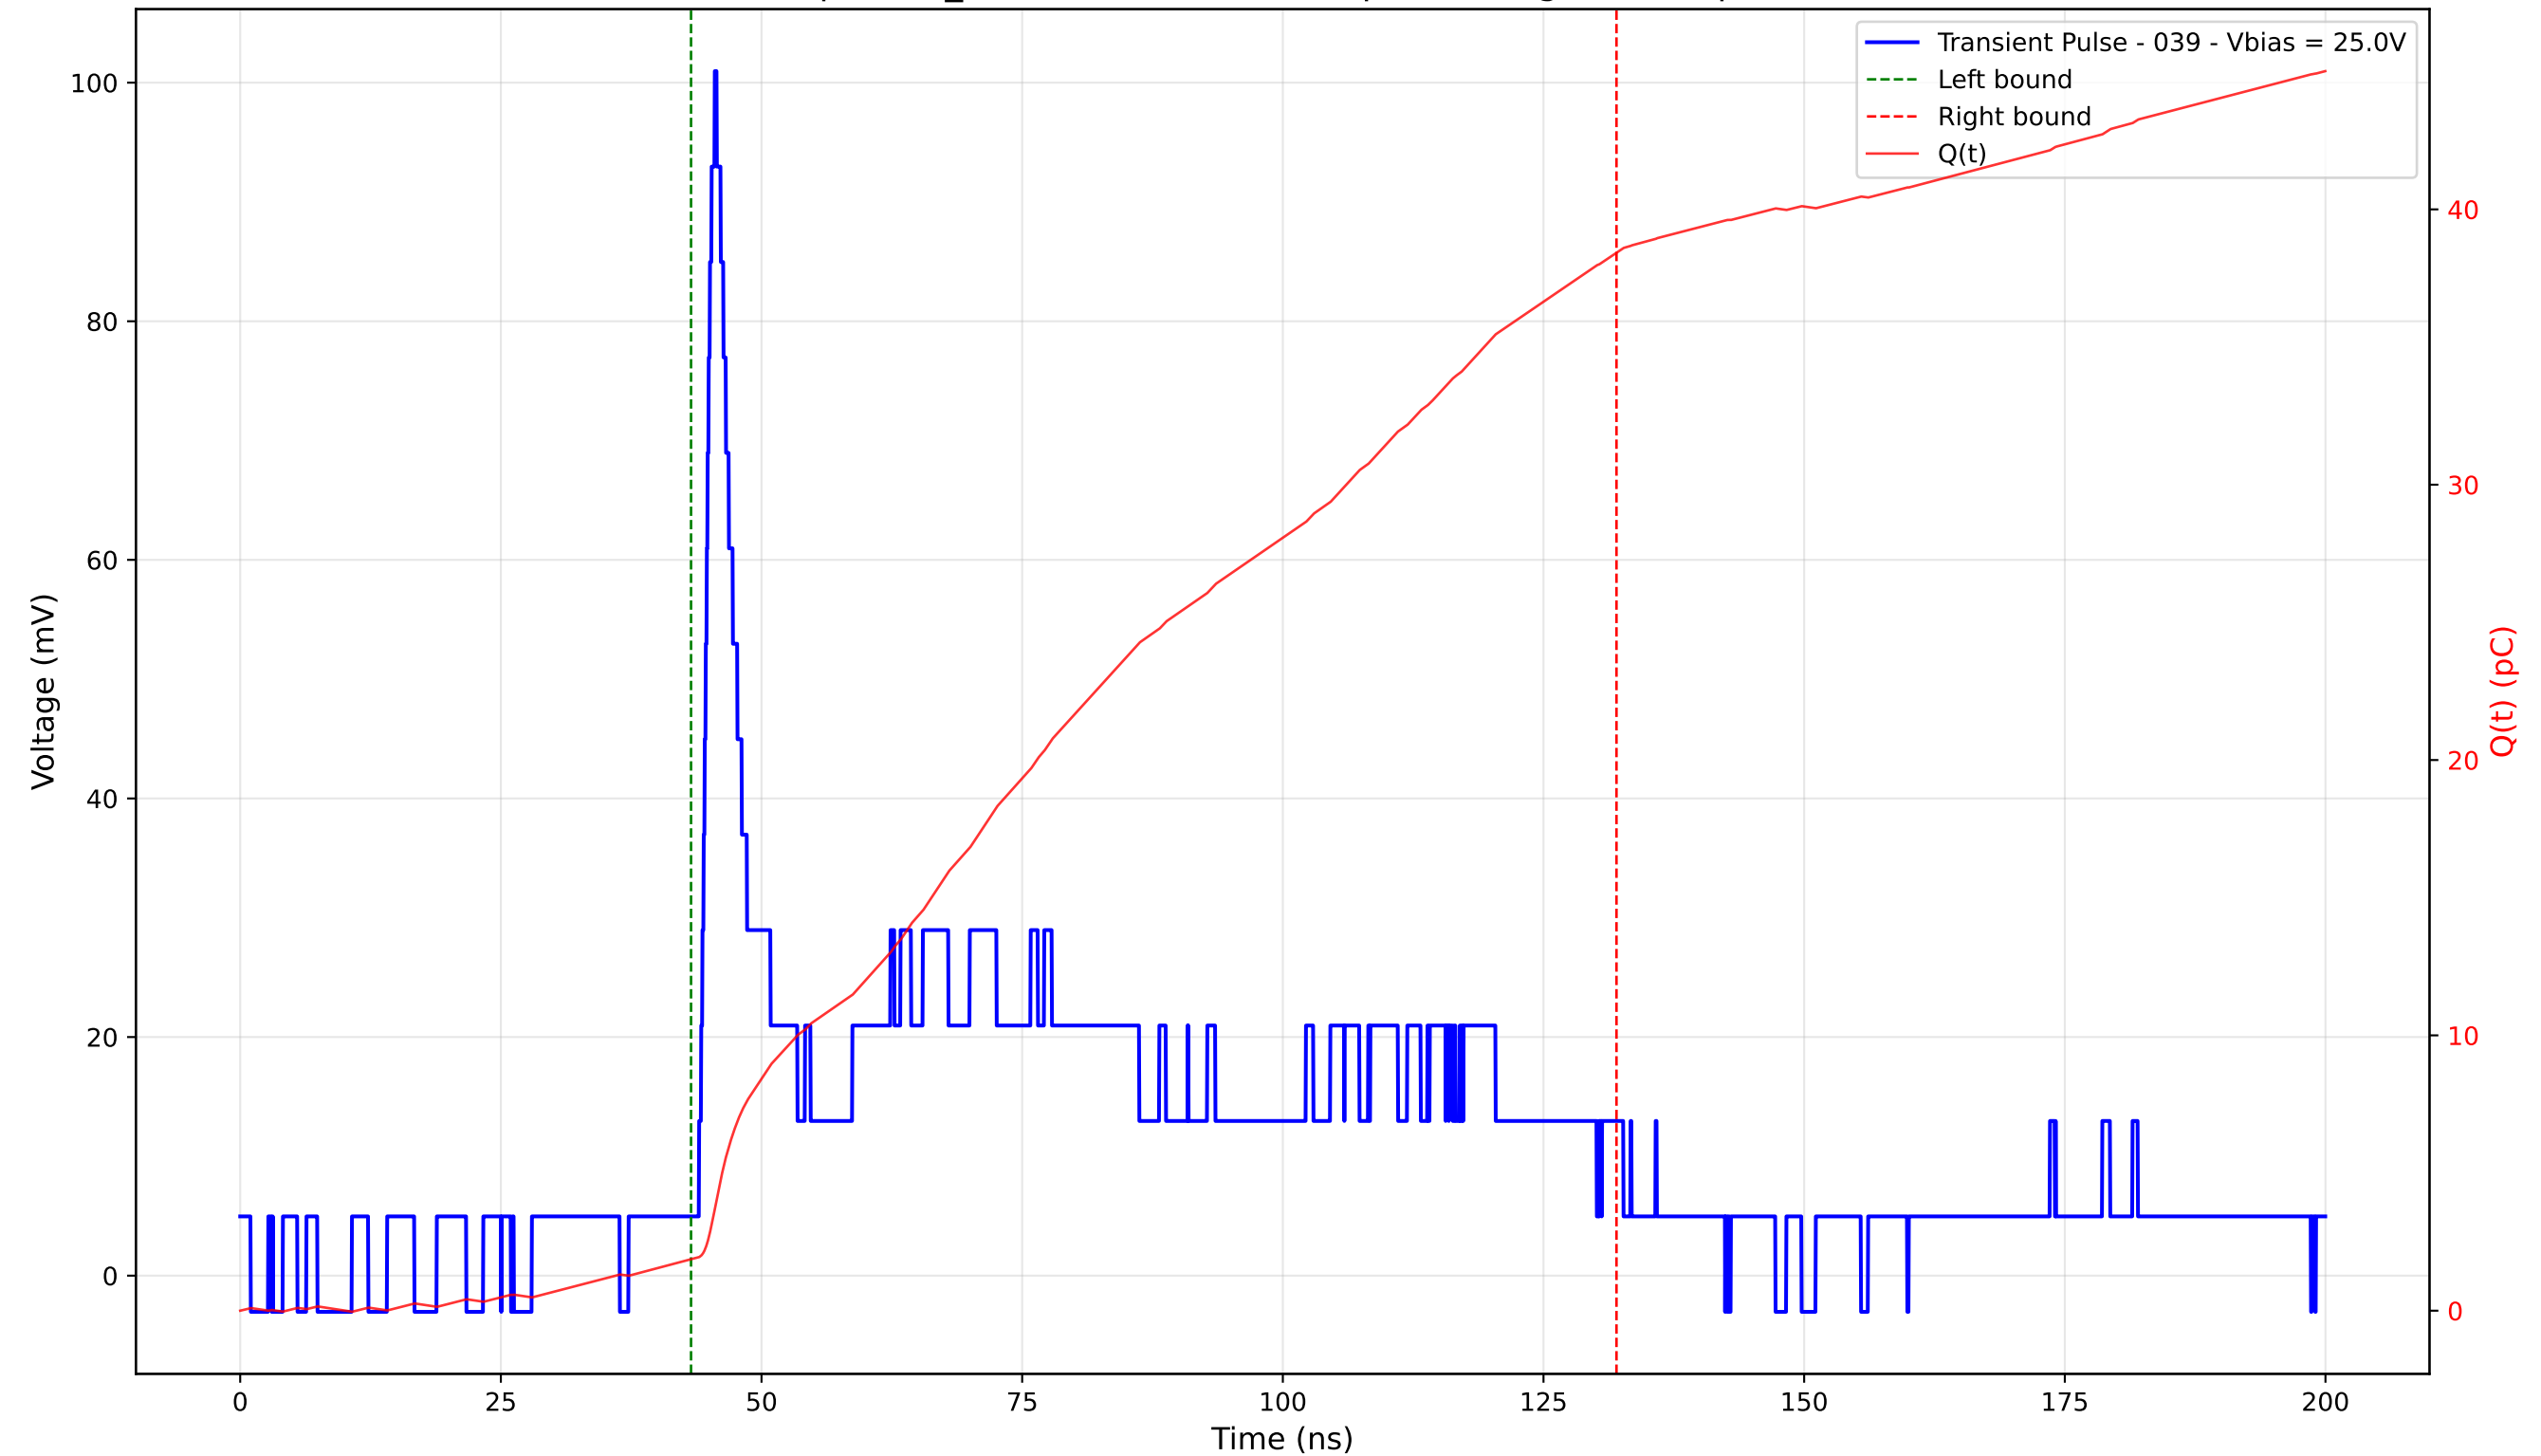


Transient Pulse - Sample: TD_4004 - Position: 300.0 μm - Charge: 8.75 pC - Rise Time: 1.12 ns

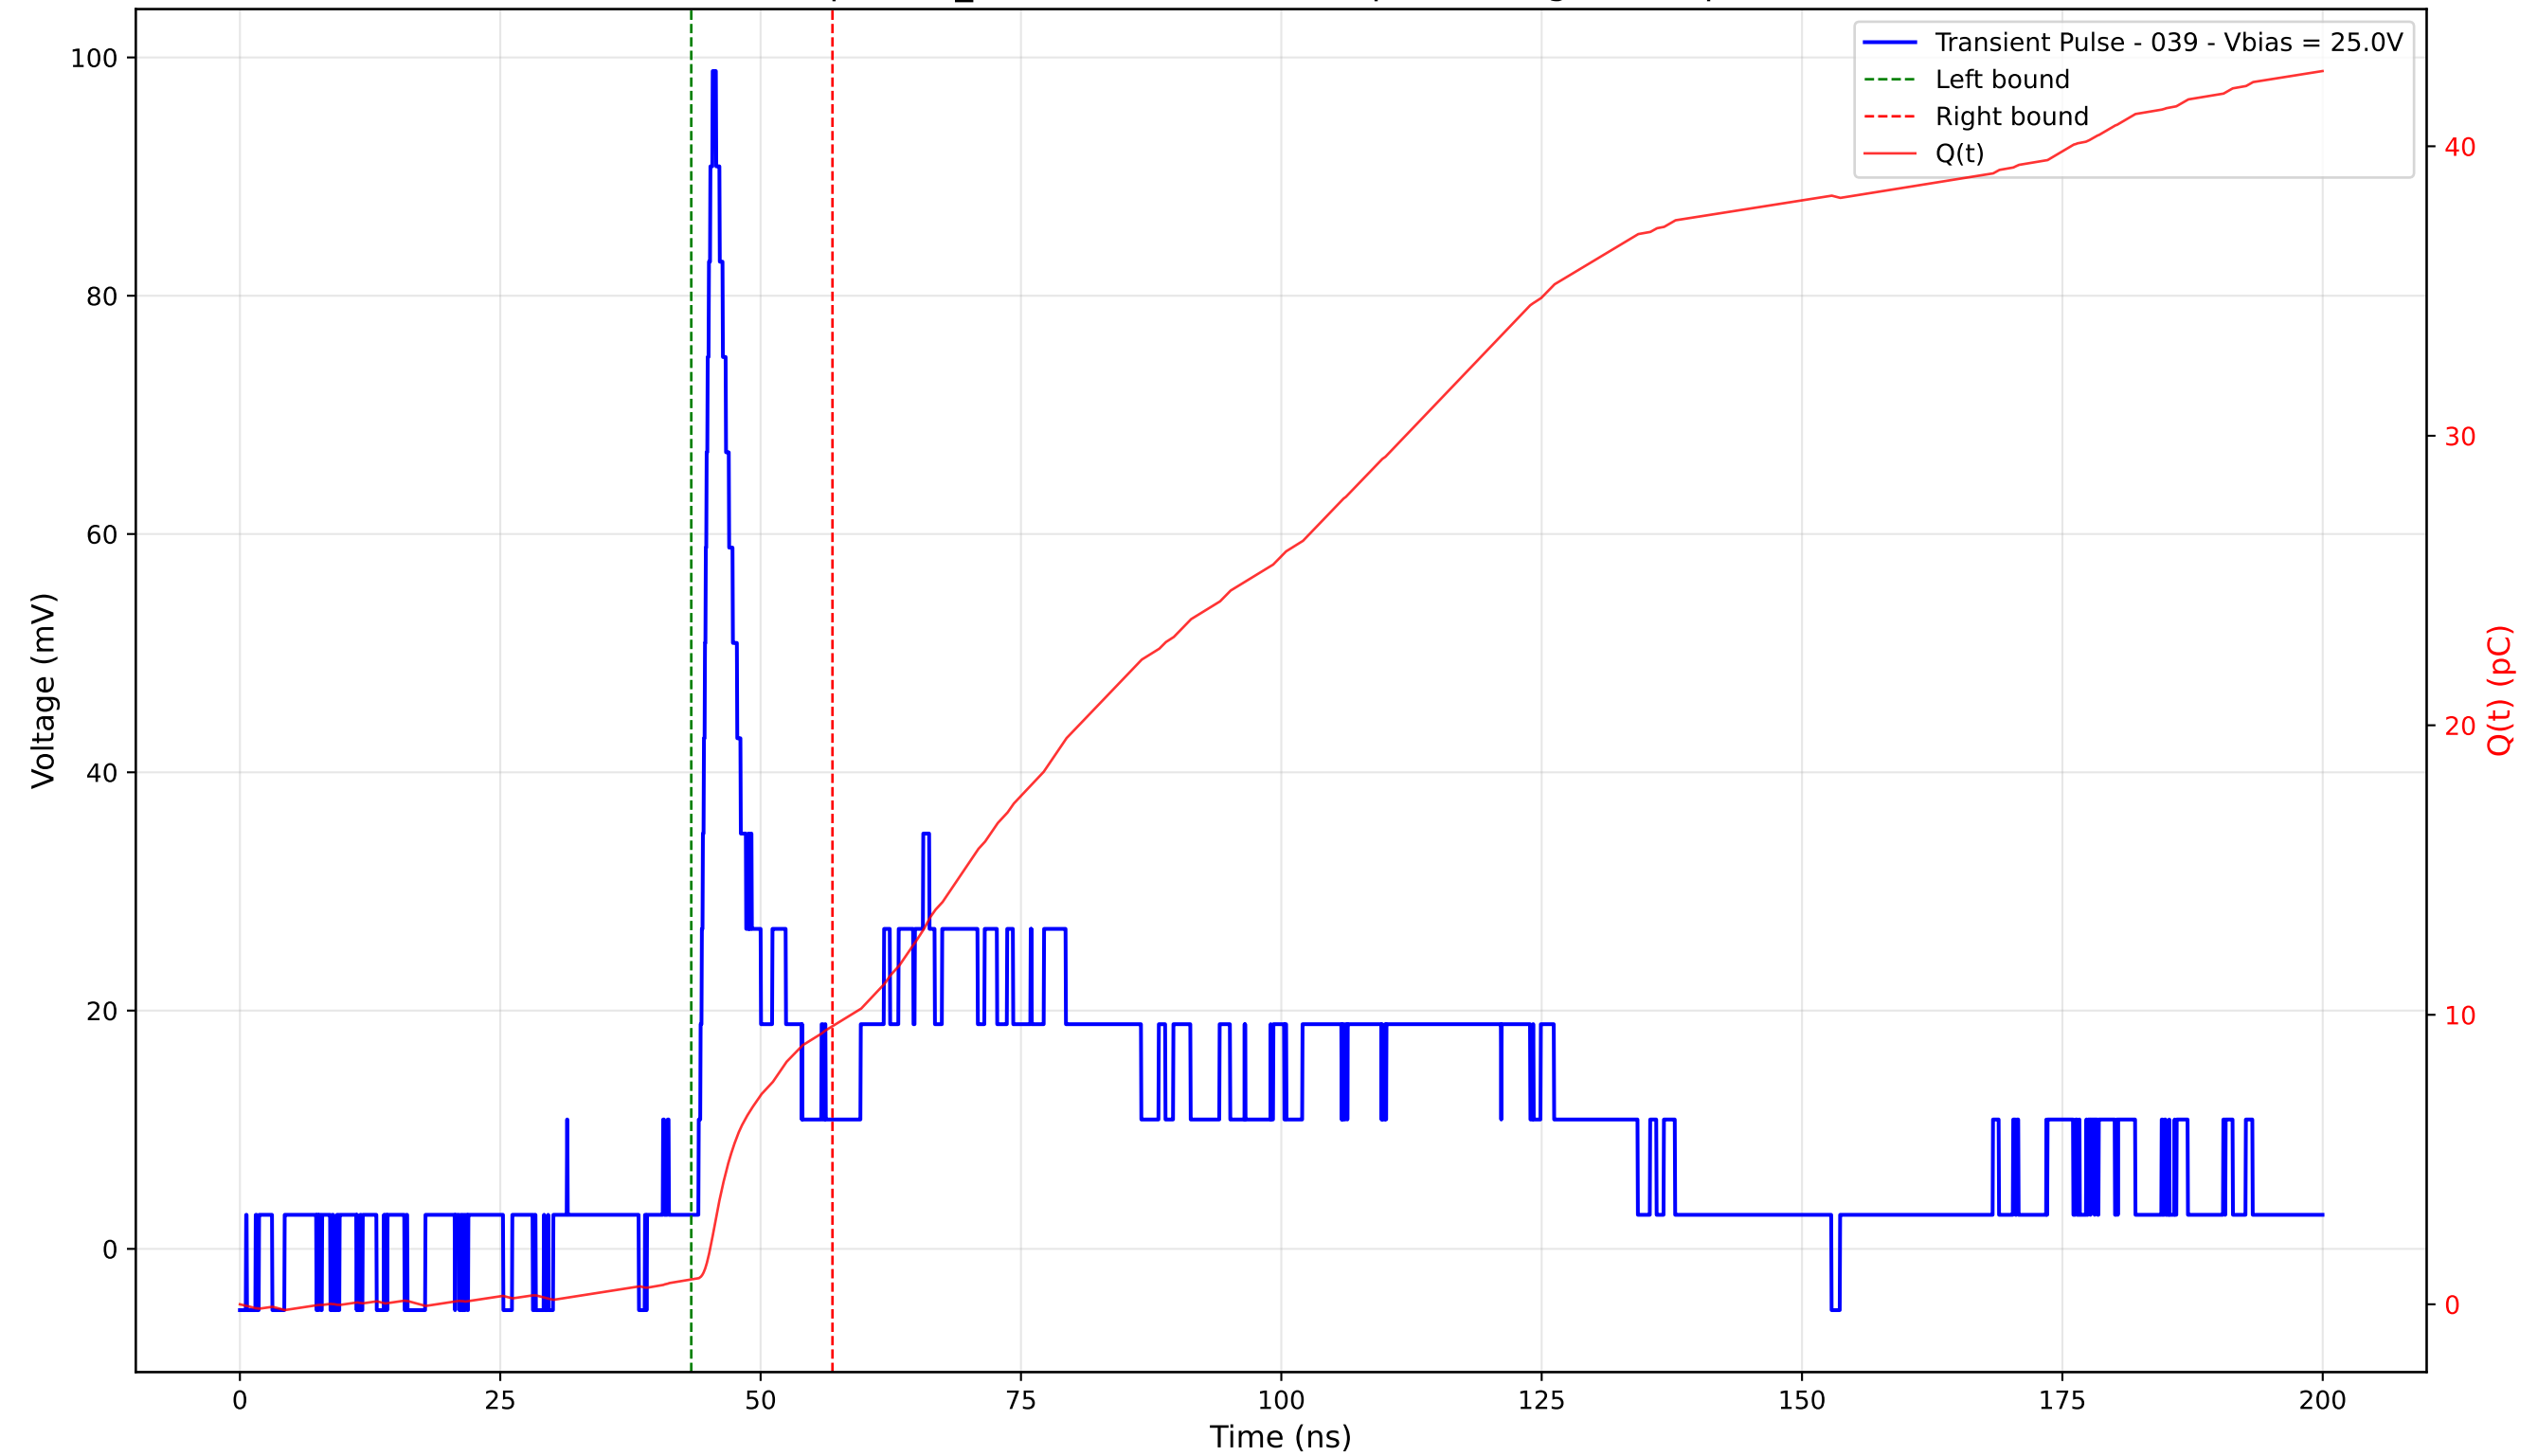


Transient Pulse - Sample: TD_4004 - Position: 305.0 μm - Charge: 7.96 pC - Rise Time: 1.06 ns

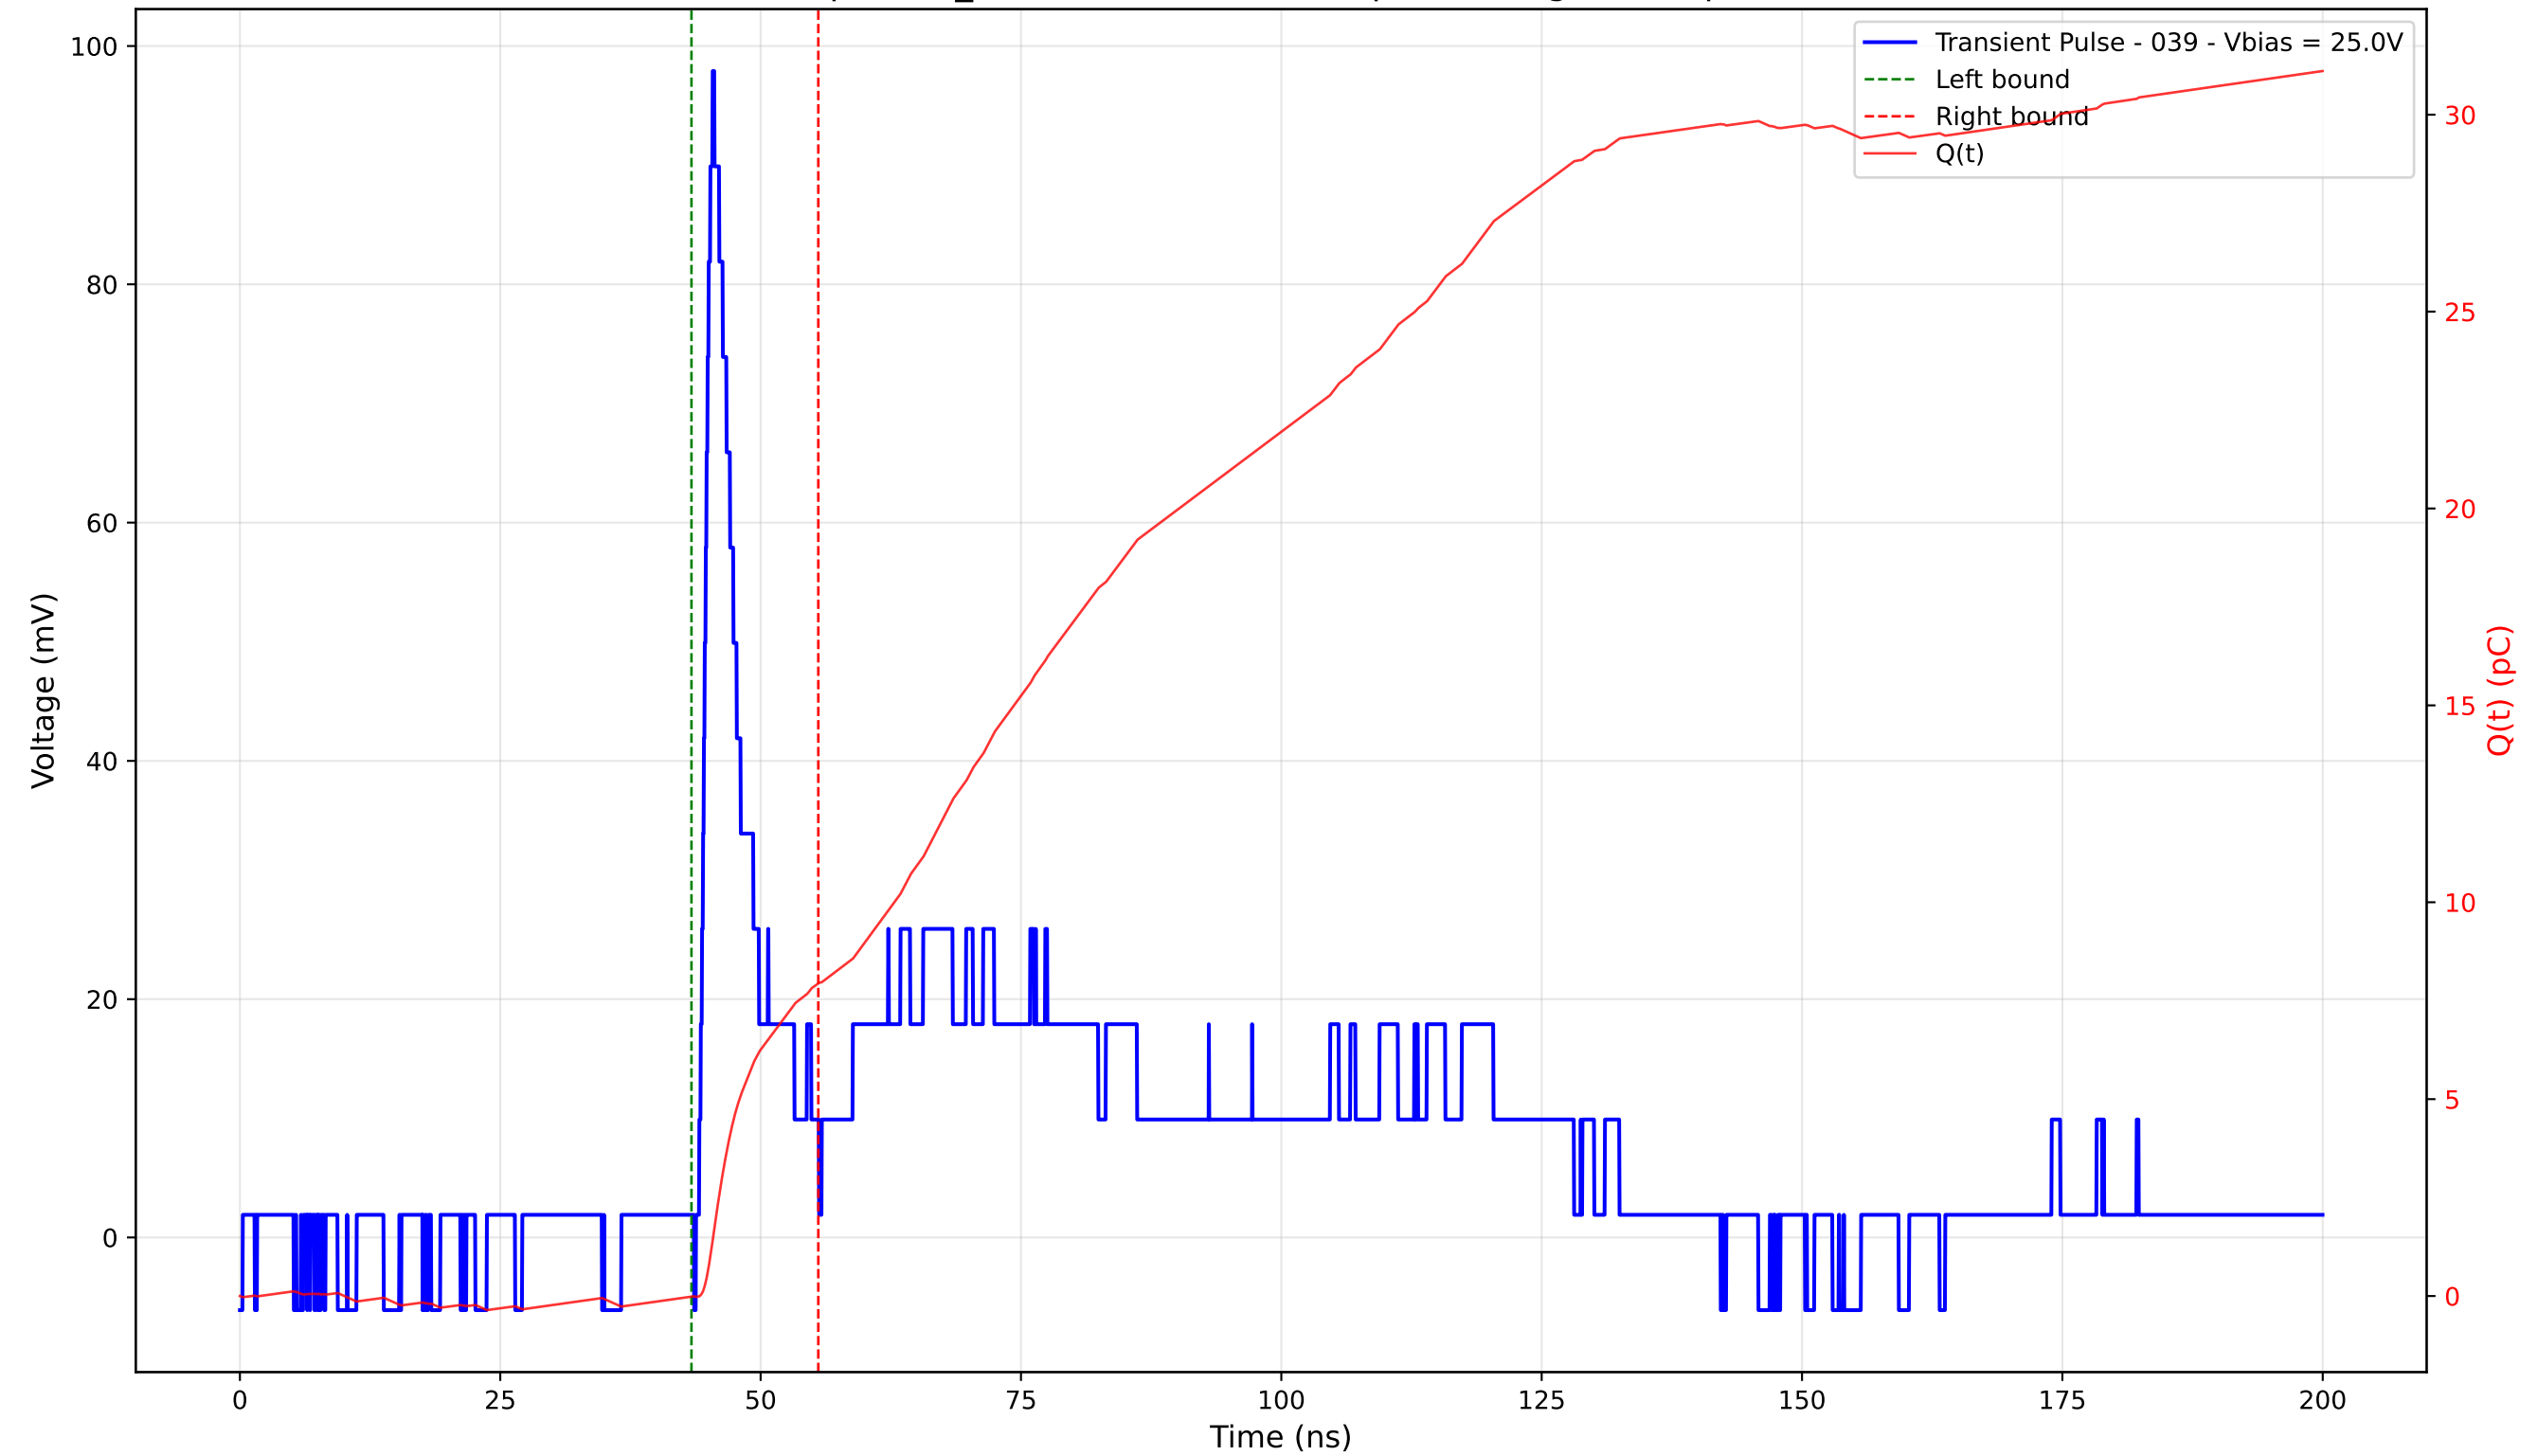


Transient Pulse - Sample: TD_4004 - Position: 310.0 μm - Charge: 7.69 pC - Rise Time: 0.96 ns

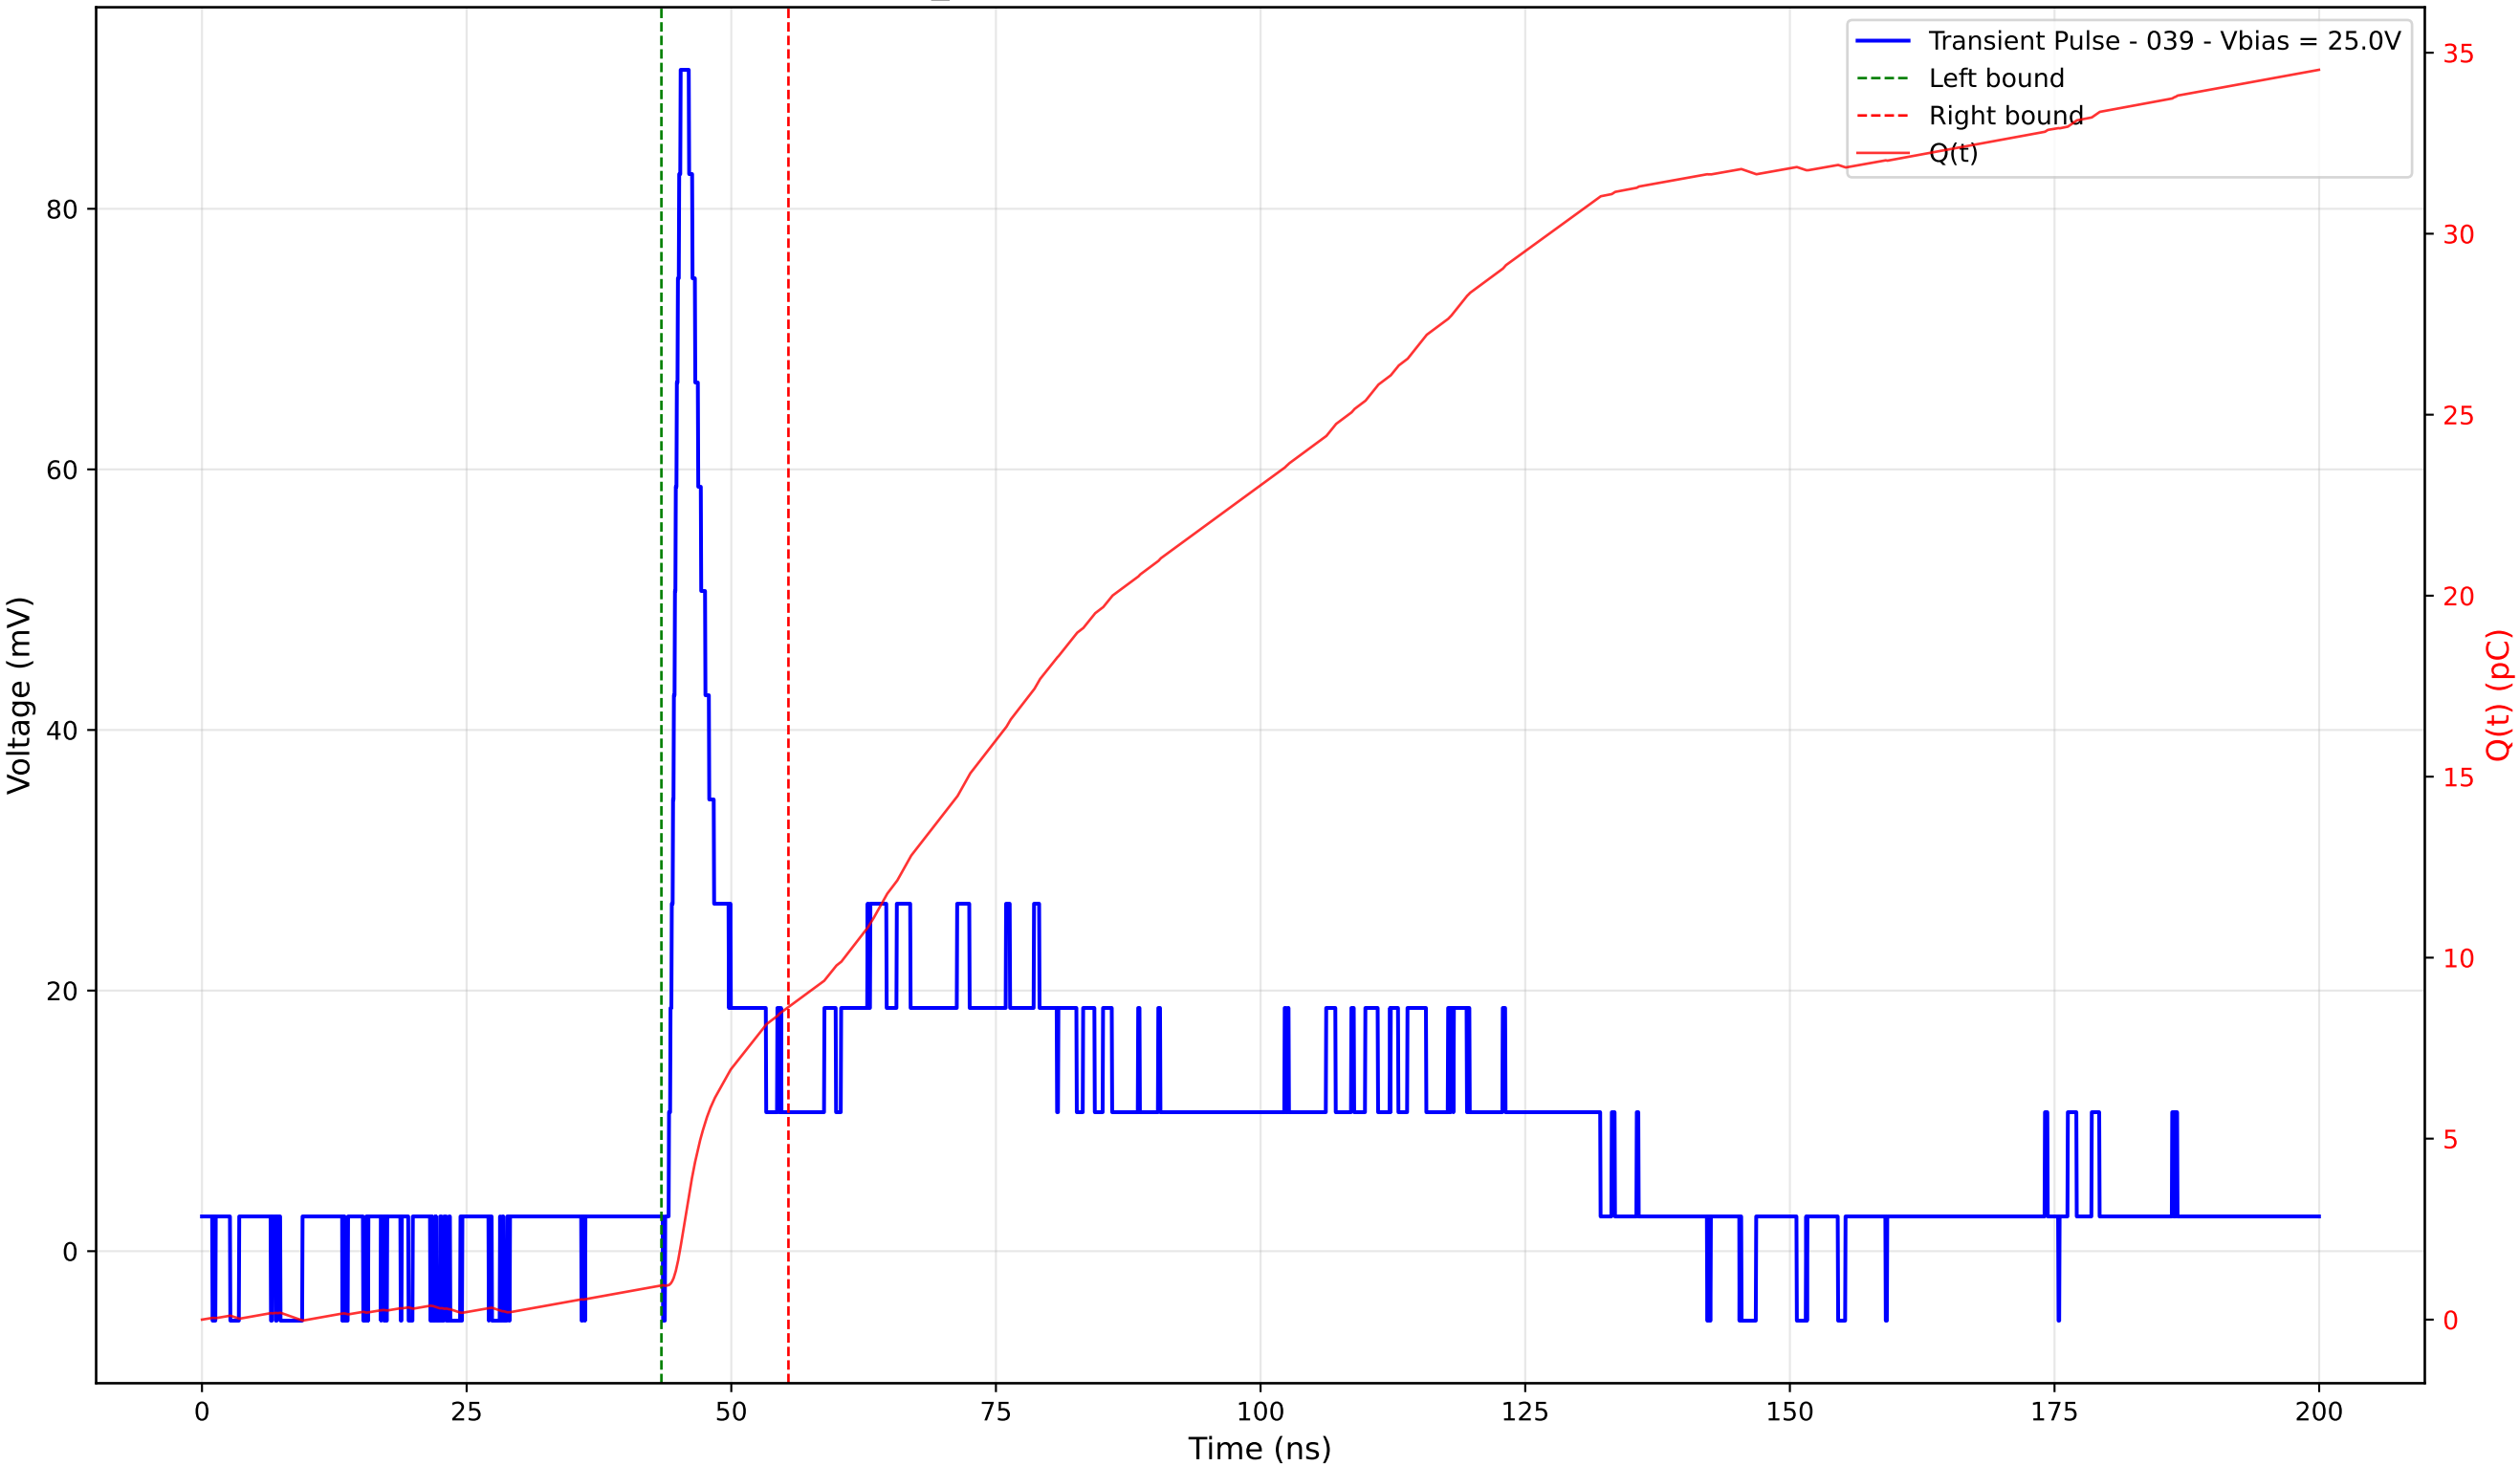


Transient Pulse - Sample: TD_4004 - Position: 315.0 μm - Charge: 7.12 pC - Rise Time: 0.99 ns

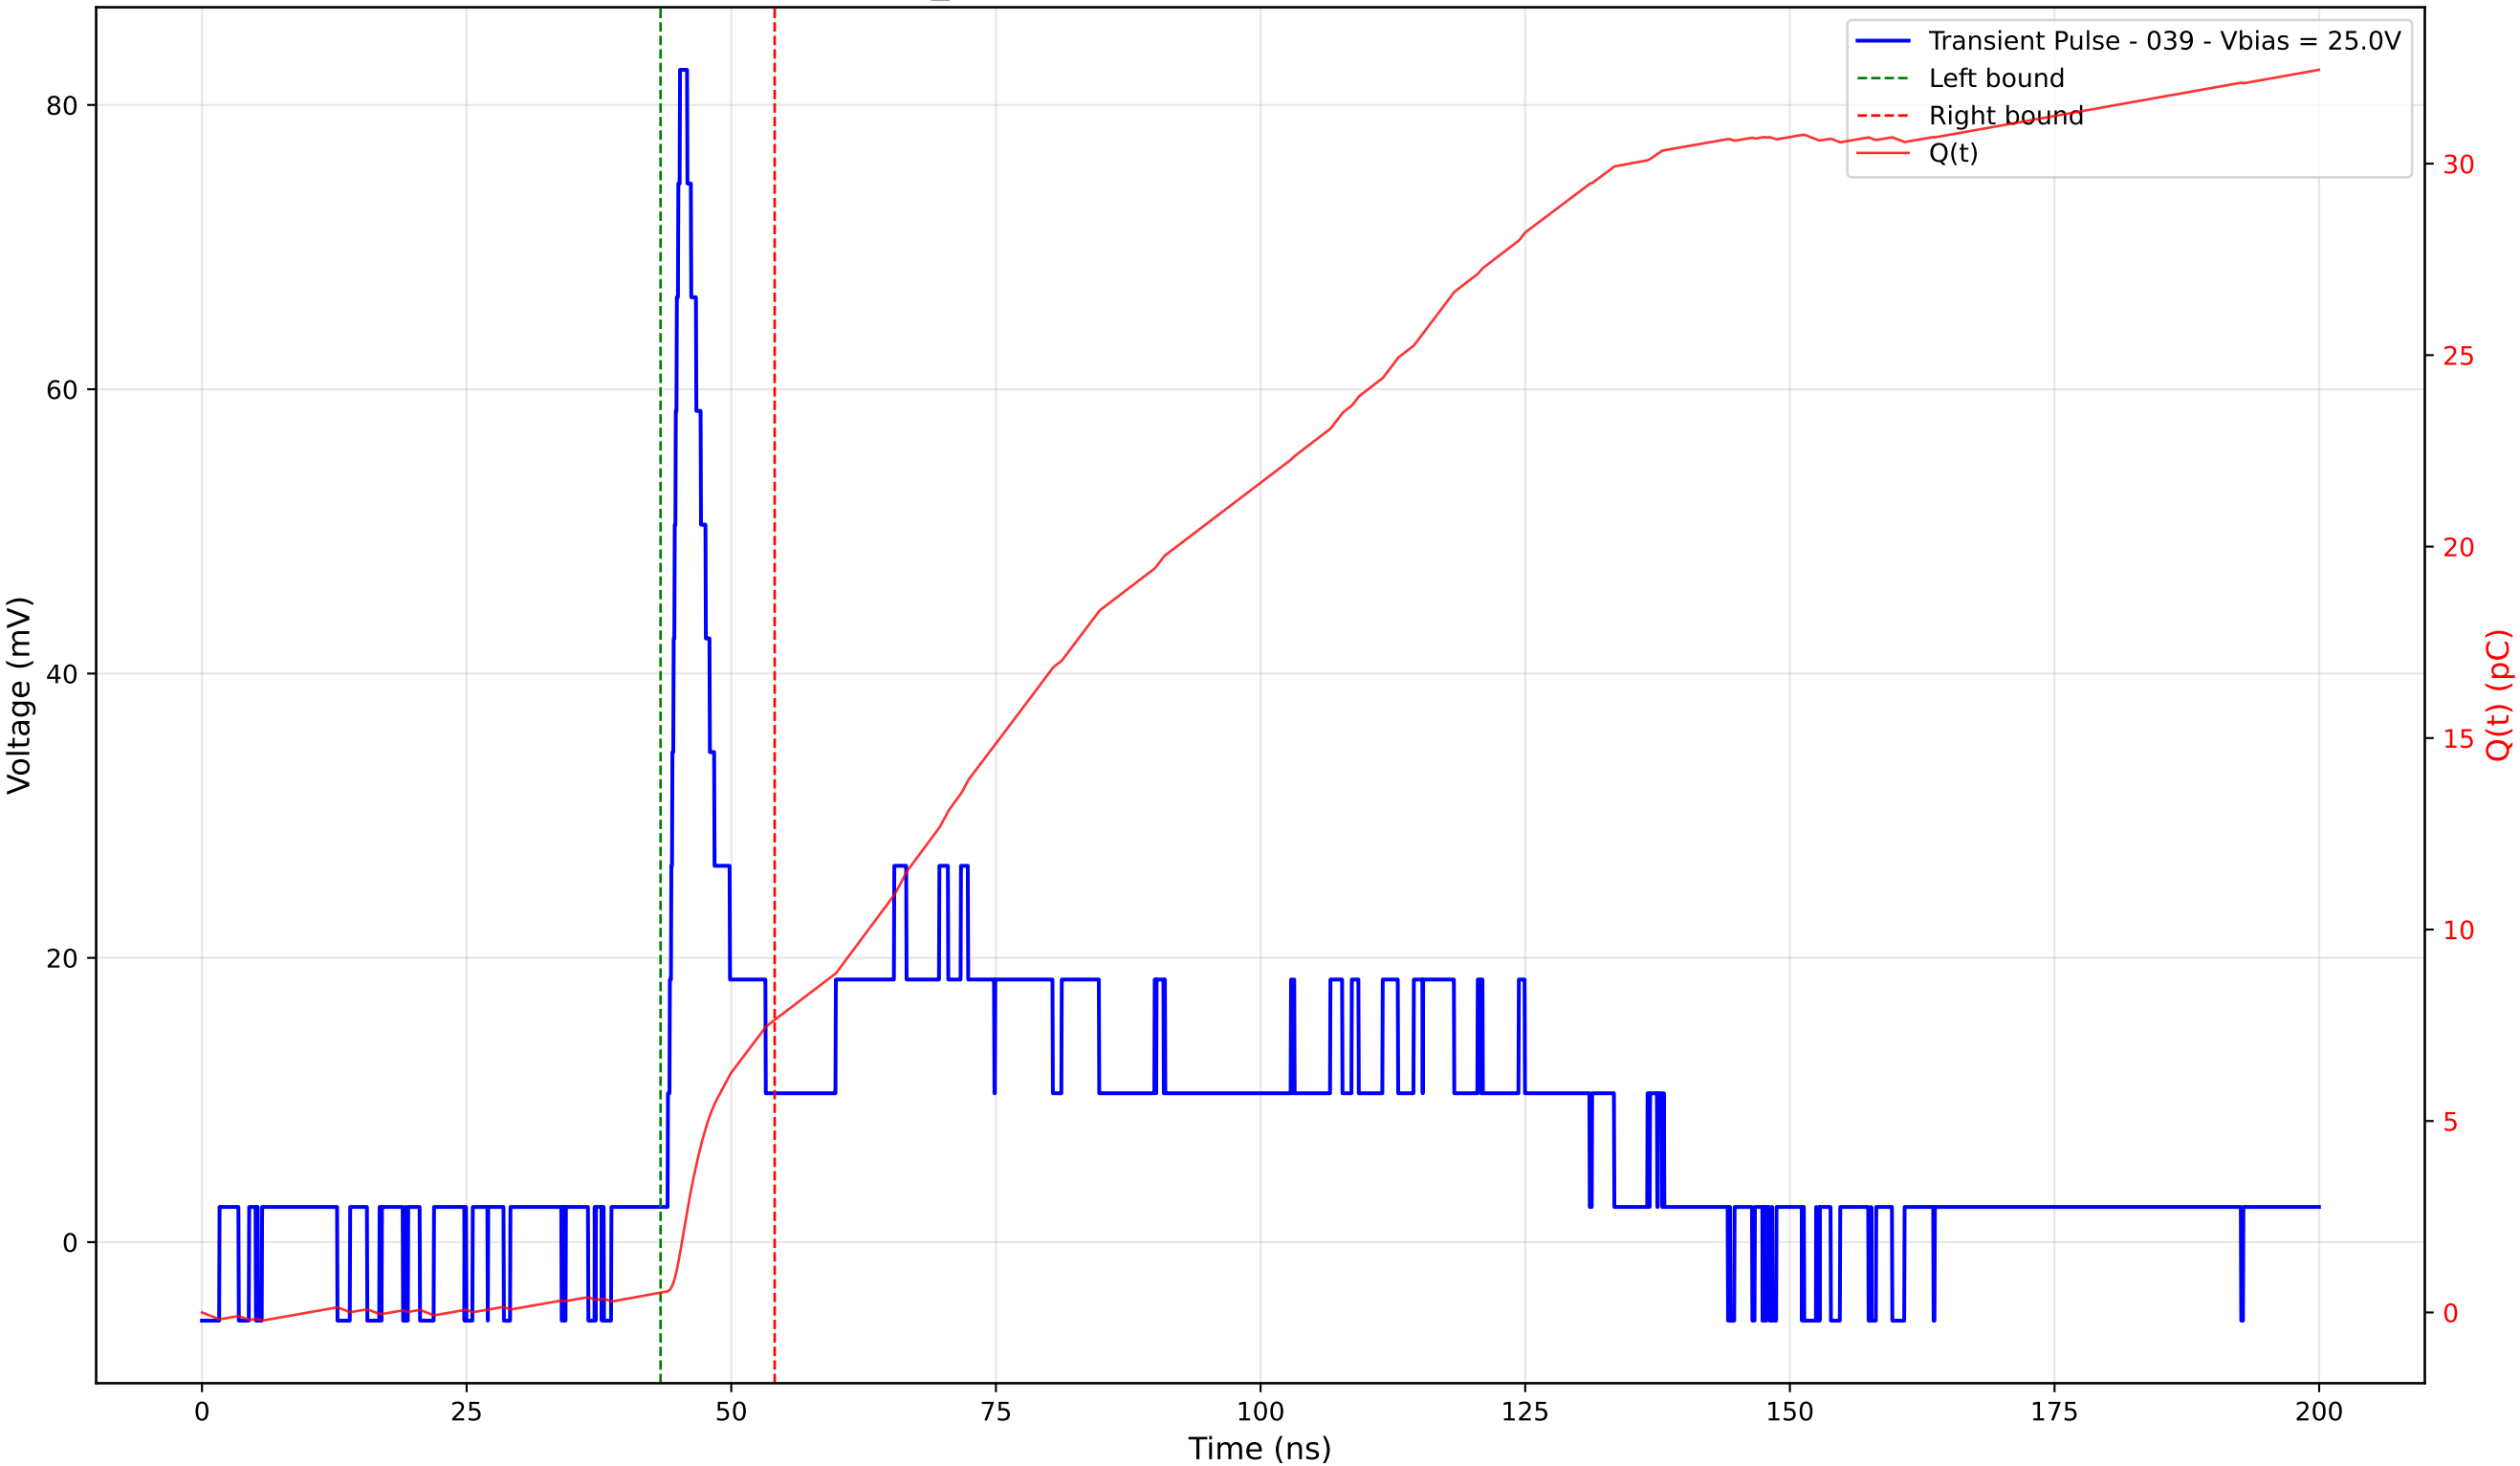


Transient Pulse - Sample: TD_4004 - Position: 320.0 μm - Charge: 7.35 pC - Rise Time: 1.11 ns

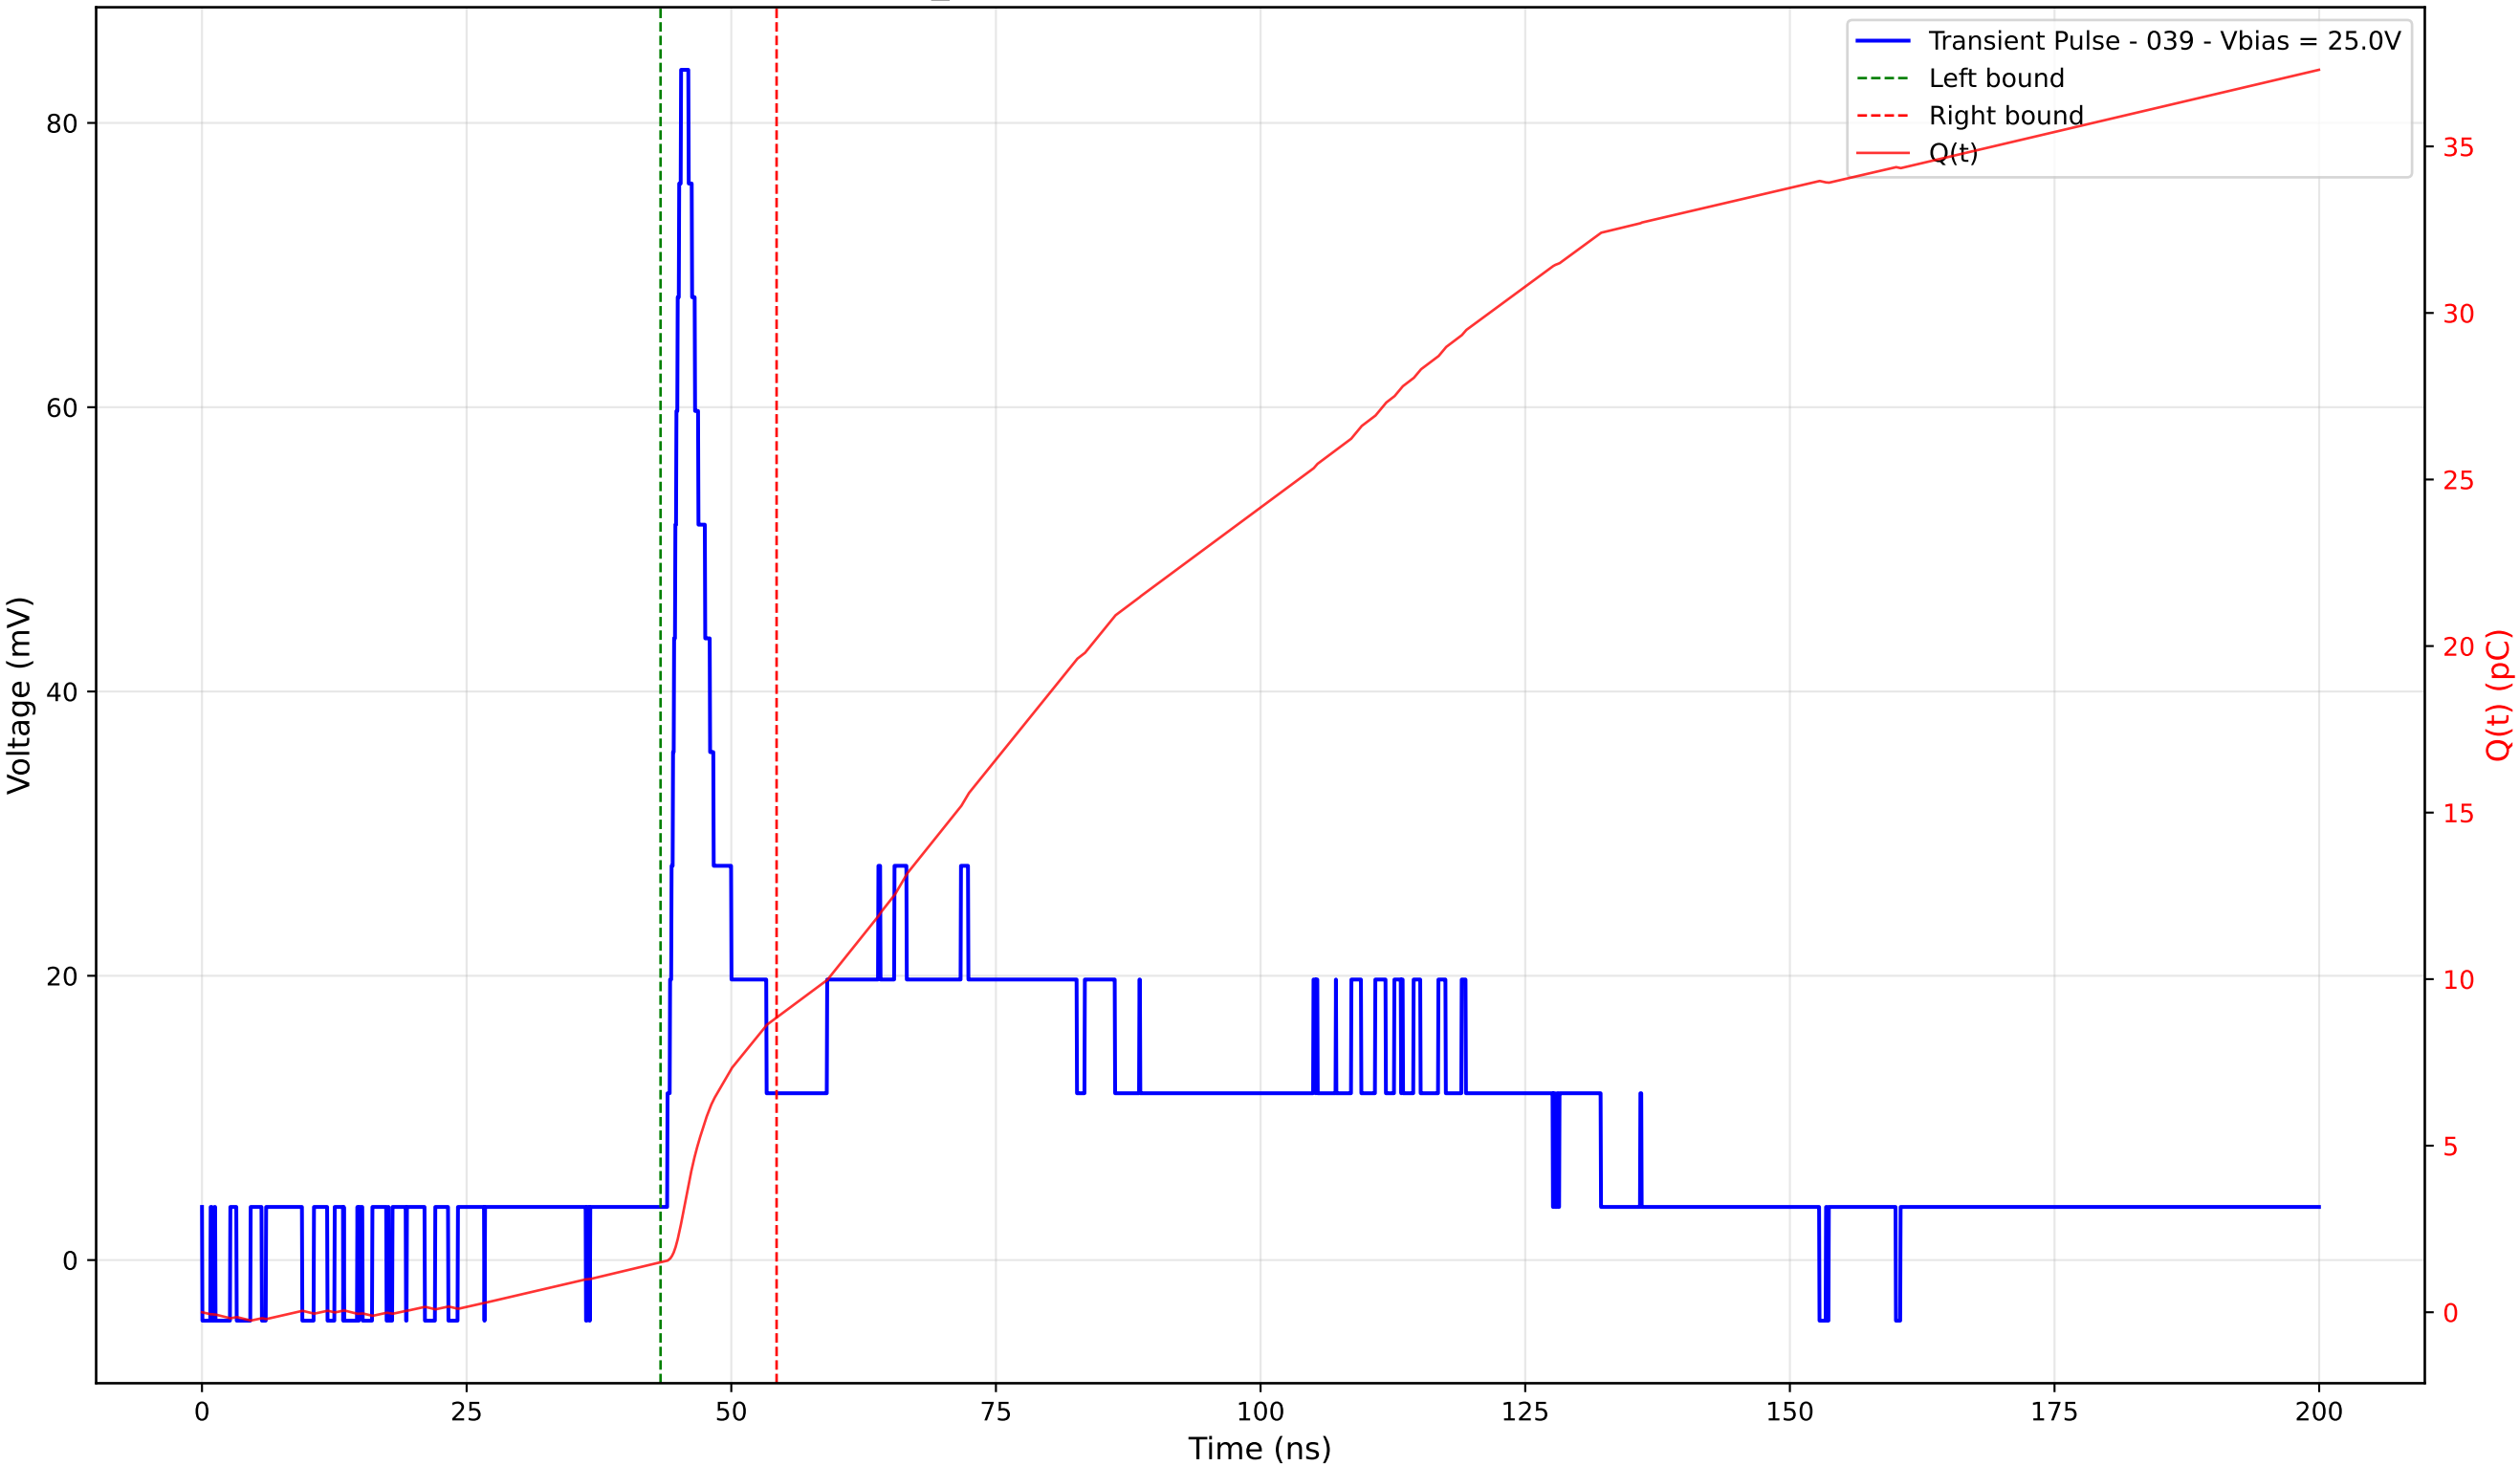


Transient Pulse - Sample: TD_4004 - Position: 325.0 μm - Charge: 51.64 pC - Rise Time: 0.96 ns

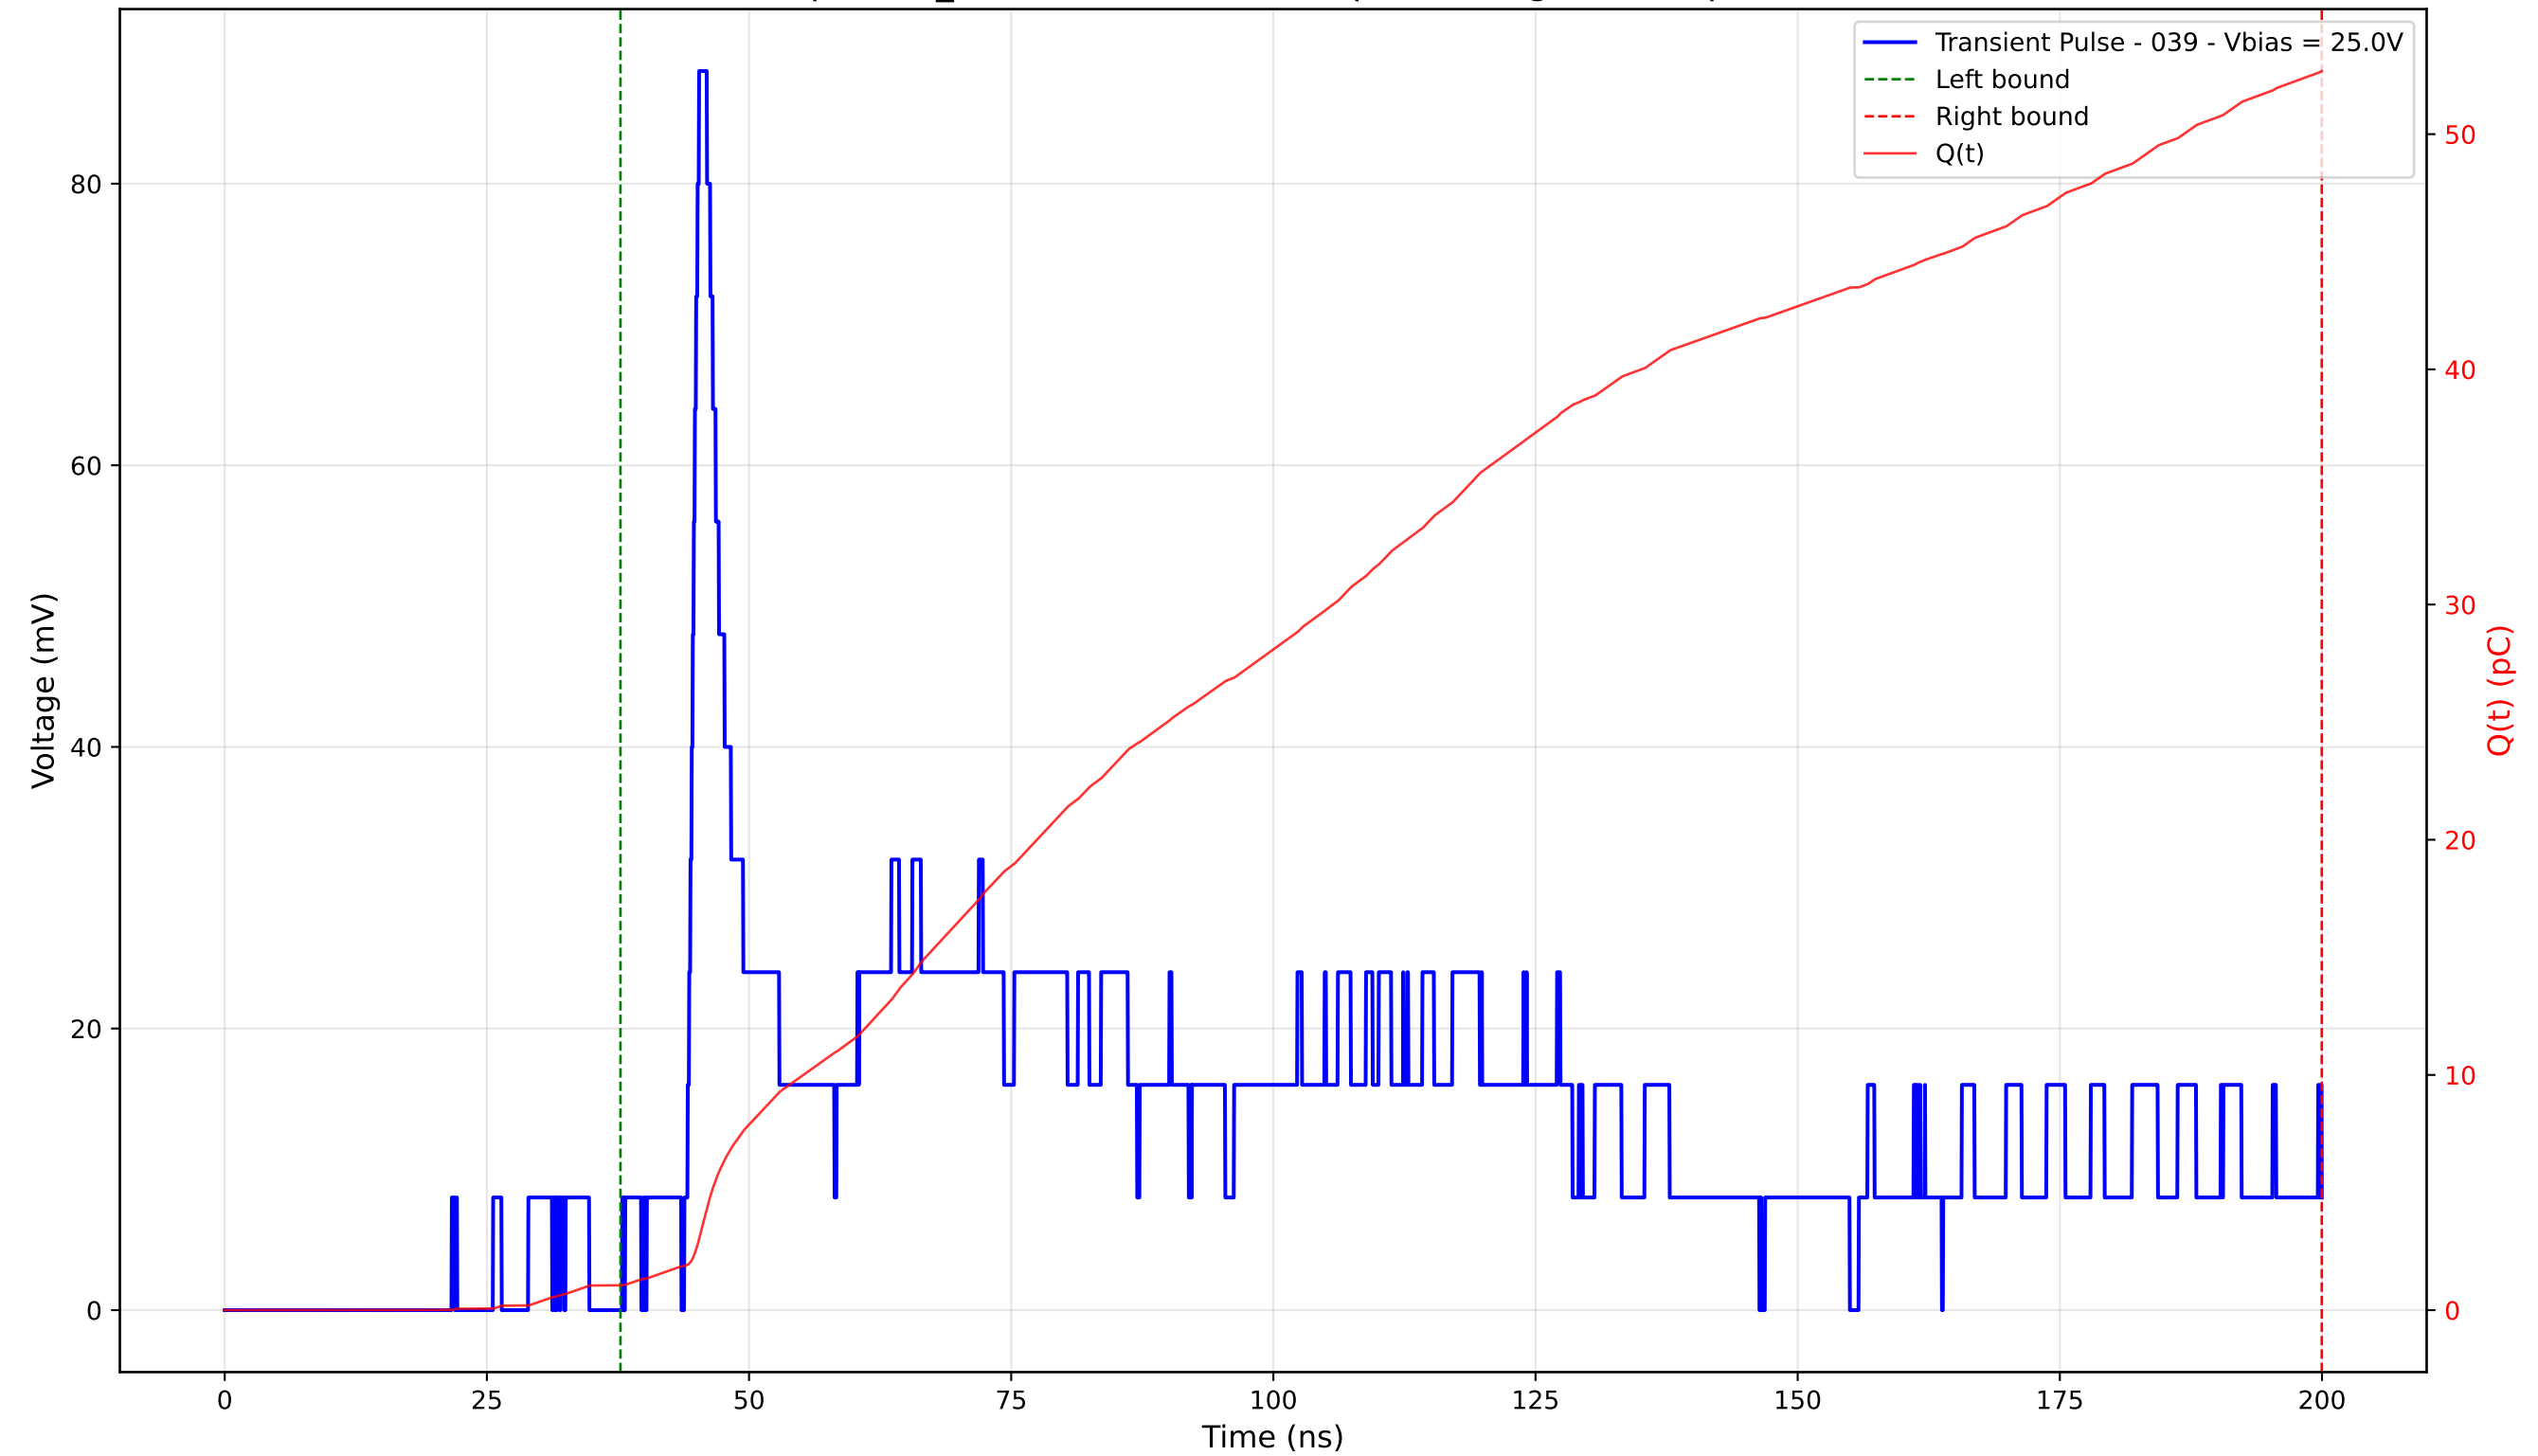


Transient Pulse - Sample: TD_4004 - Position: 330.0 μm - Charge: 6.52 pC - Rise Time: 1.11 ns

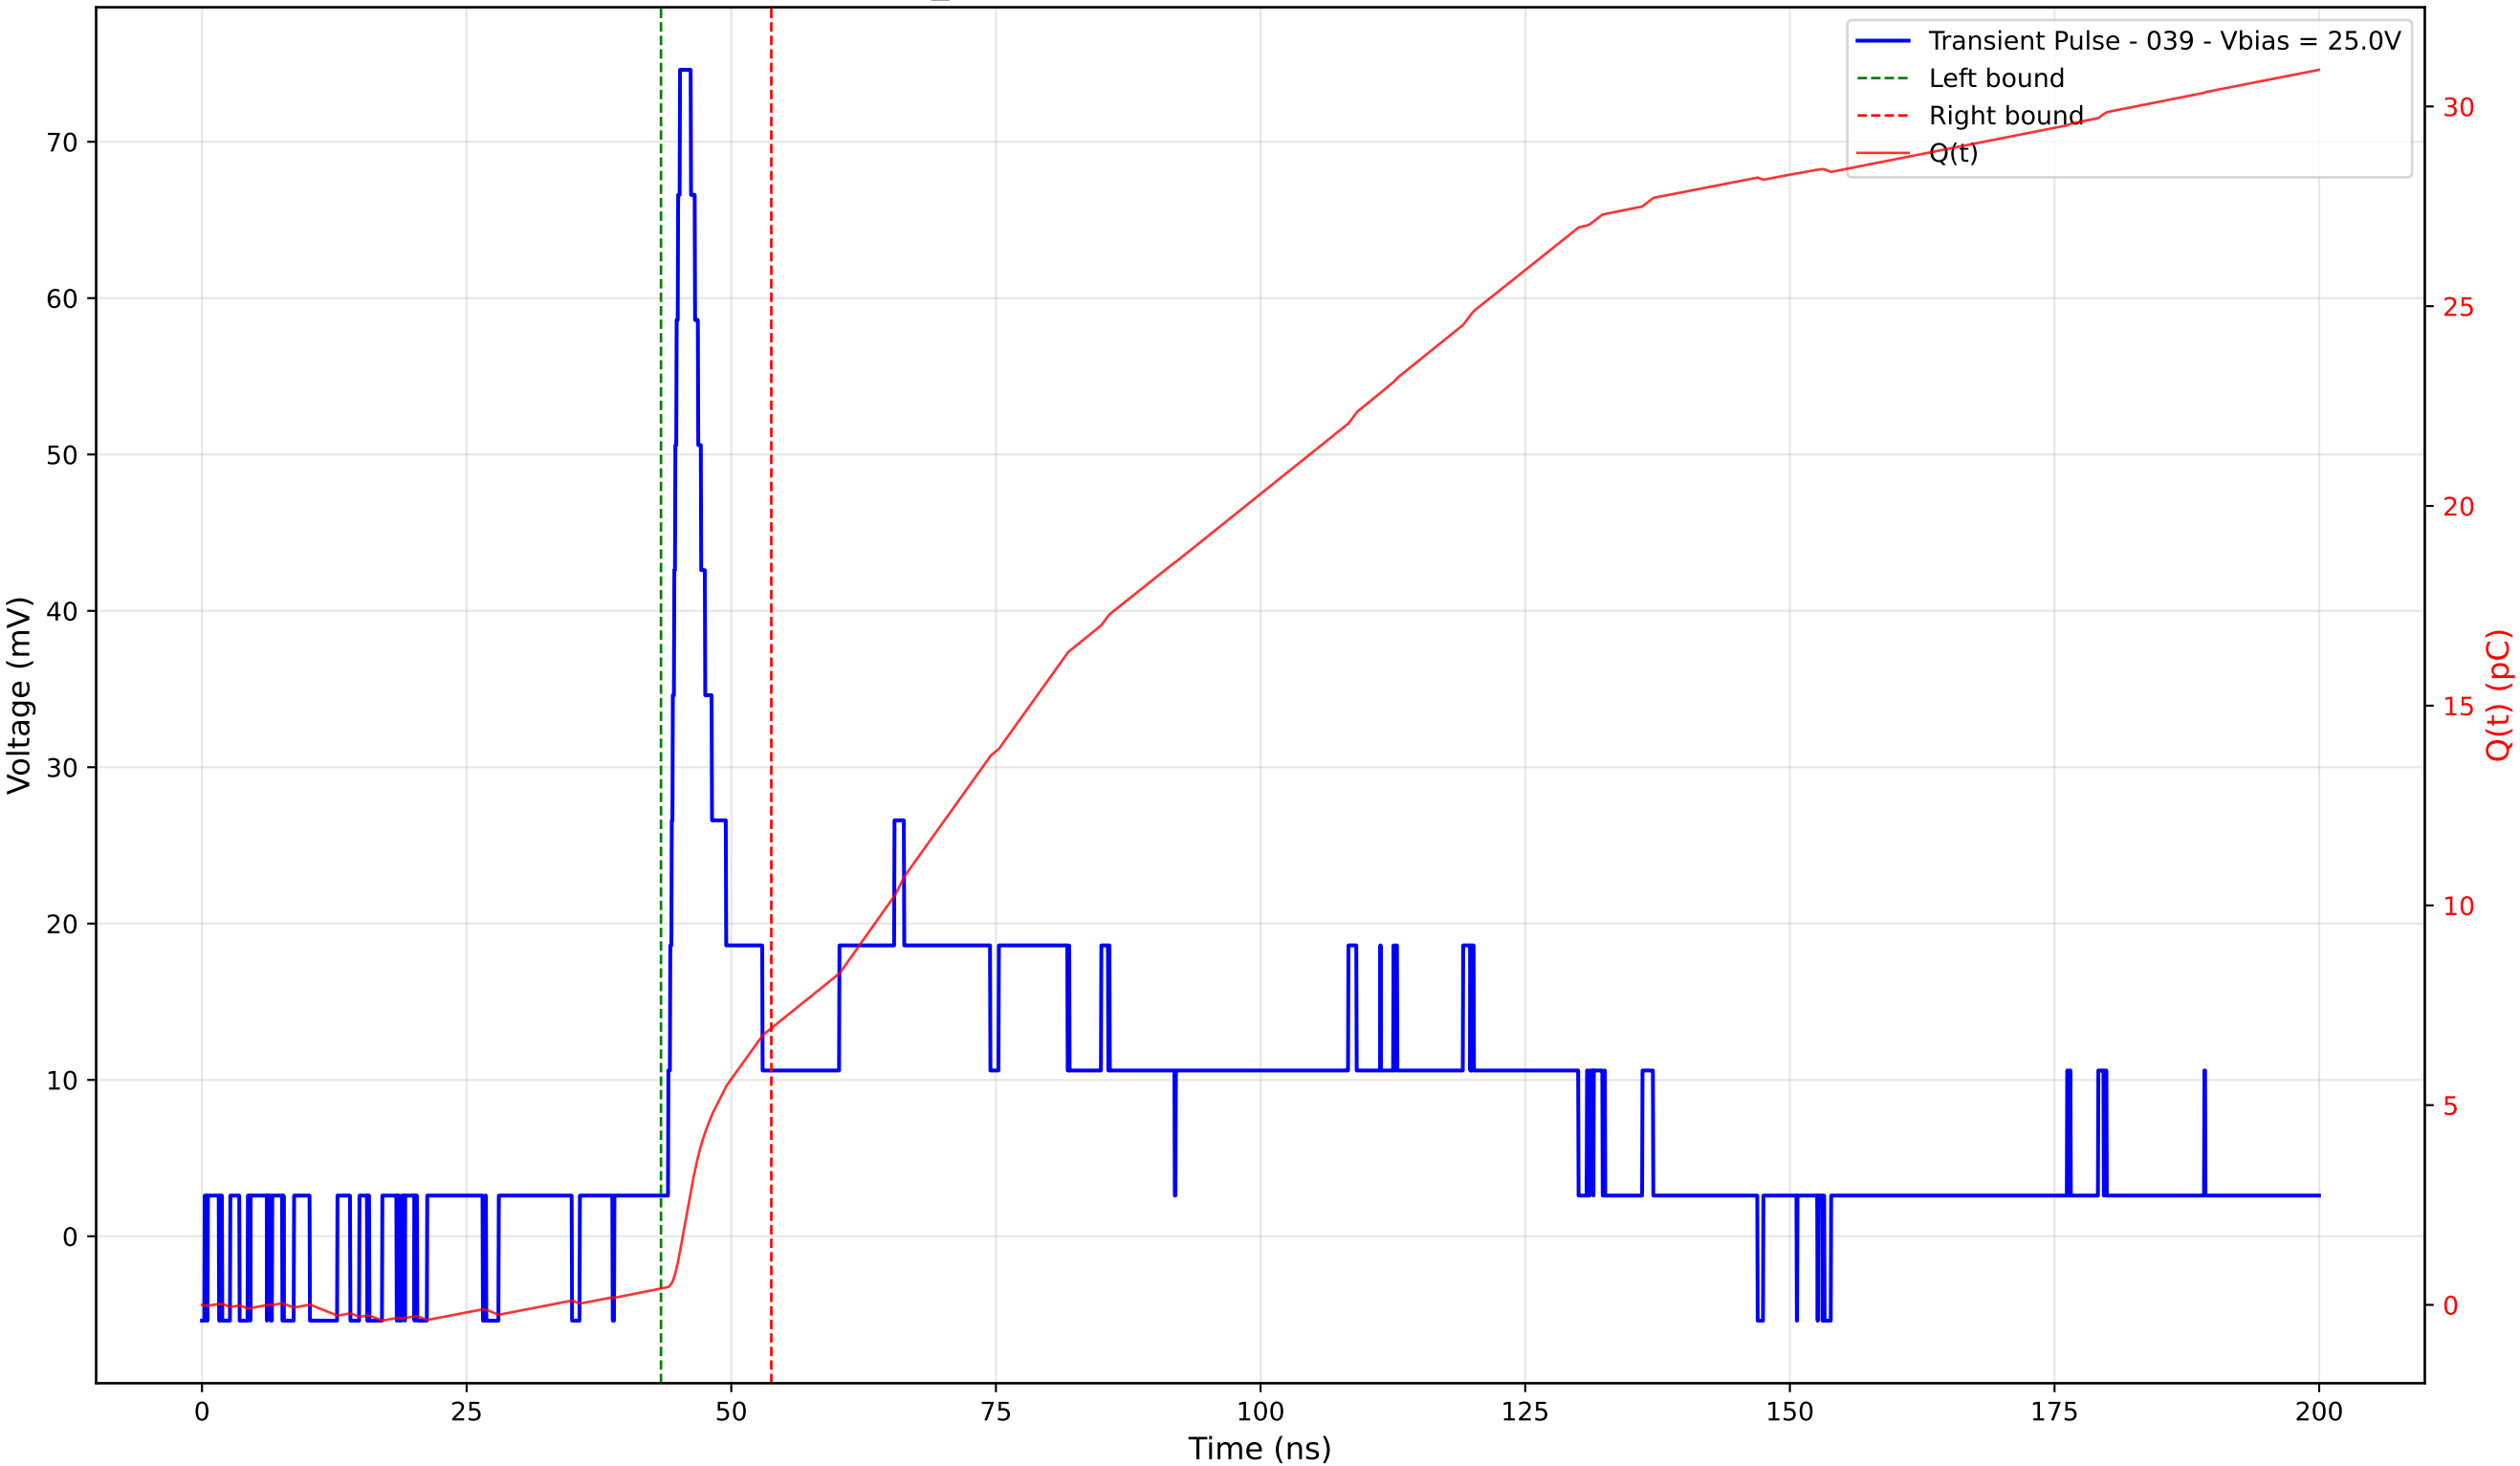


Transient Pulse - Sample: TD_4004 - Position: 335.0 μm - Charge: 6.06 pC - Rise Time: 1.39 ns

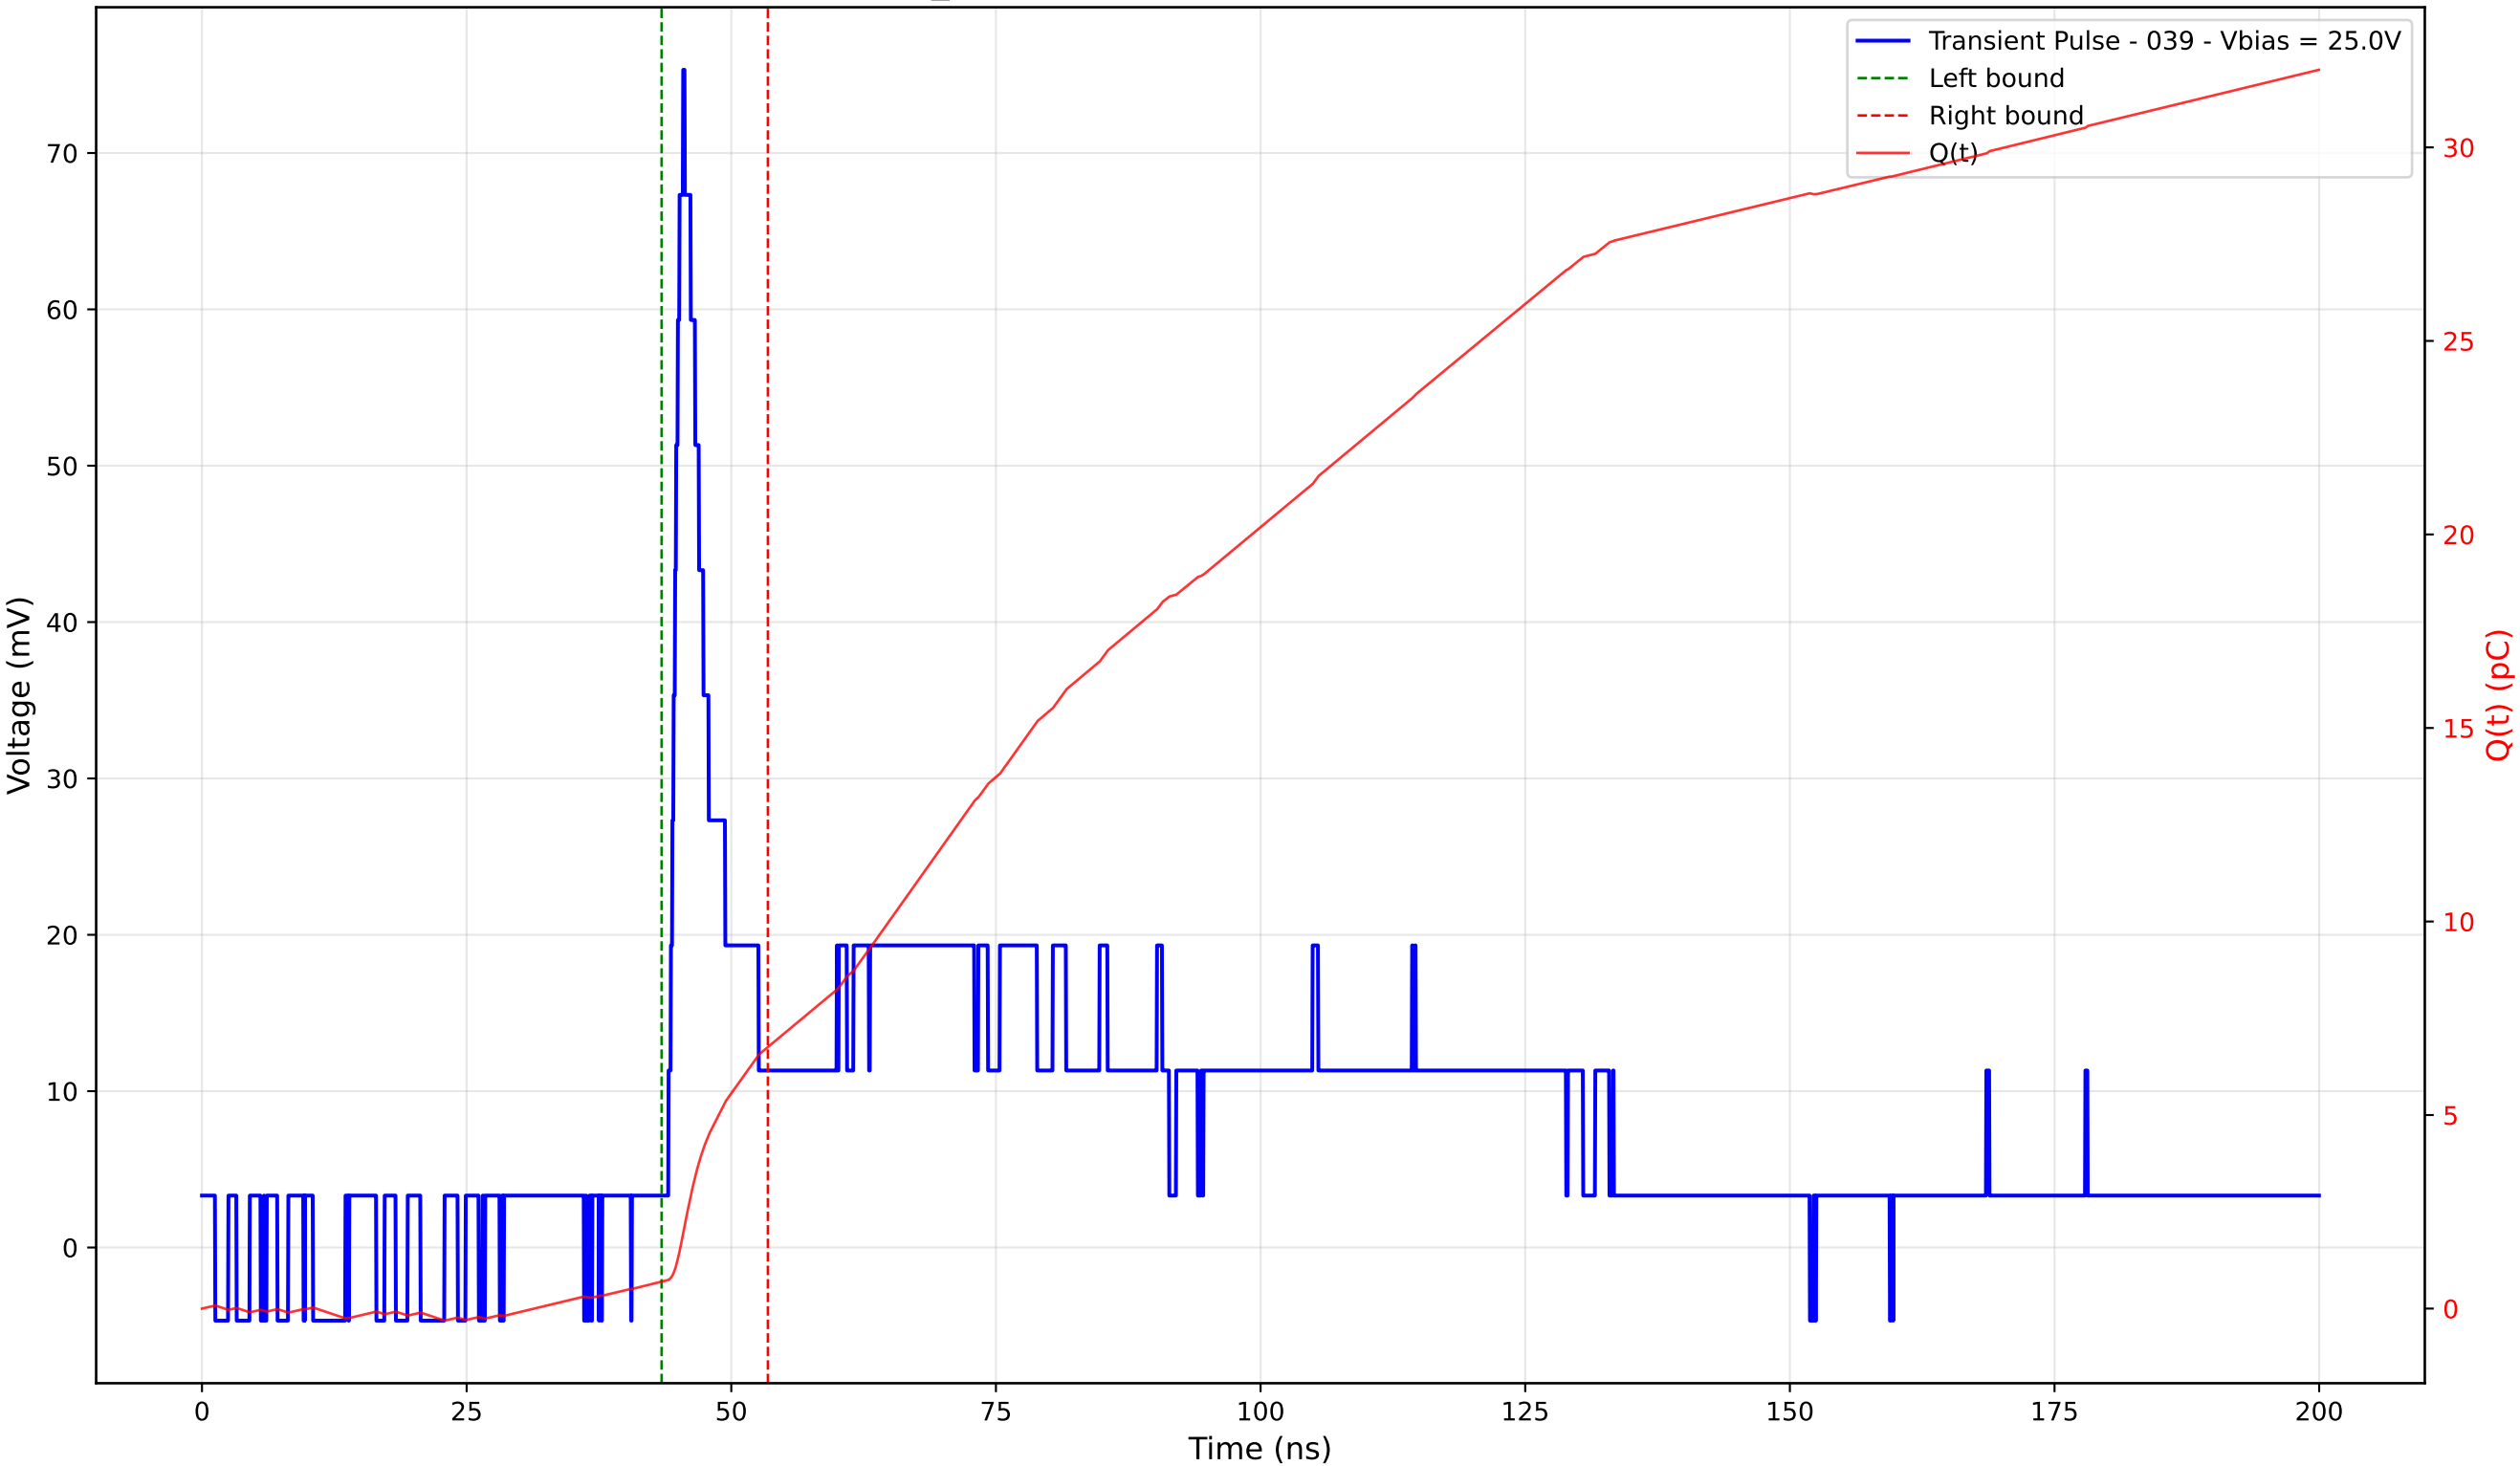


Transient Pulse - Sample: TD_4004 - Position: 340.0 μm - Charge: 6.00 pC - Rise Time: 1.09 ns

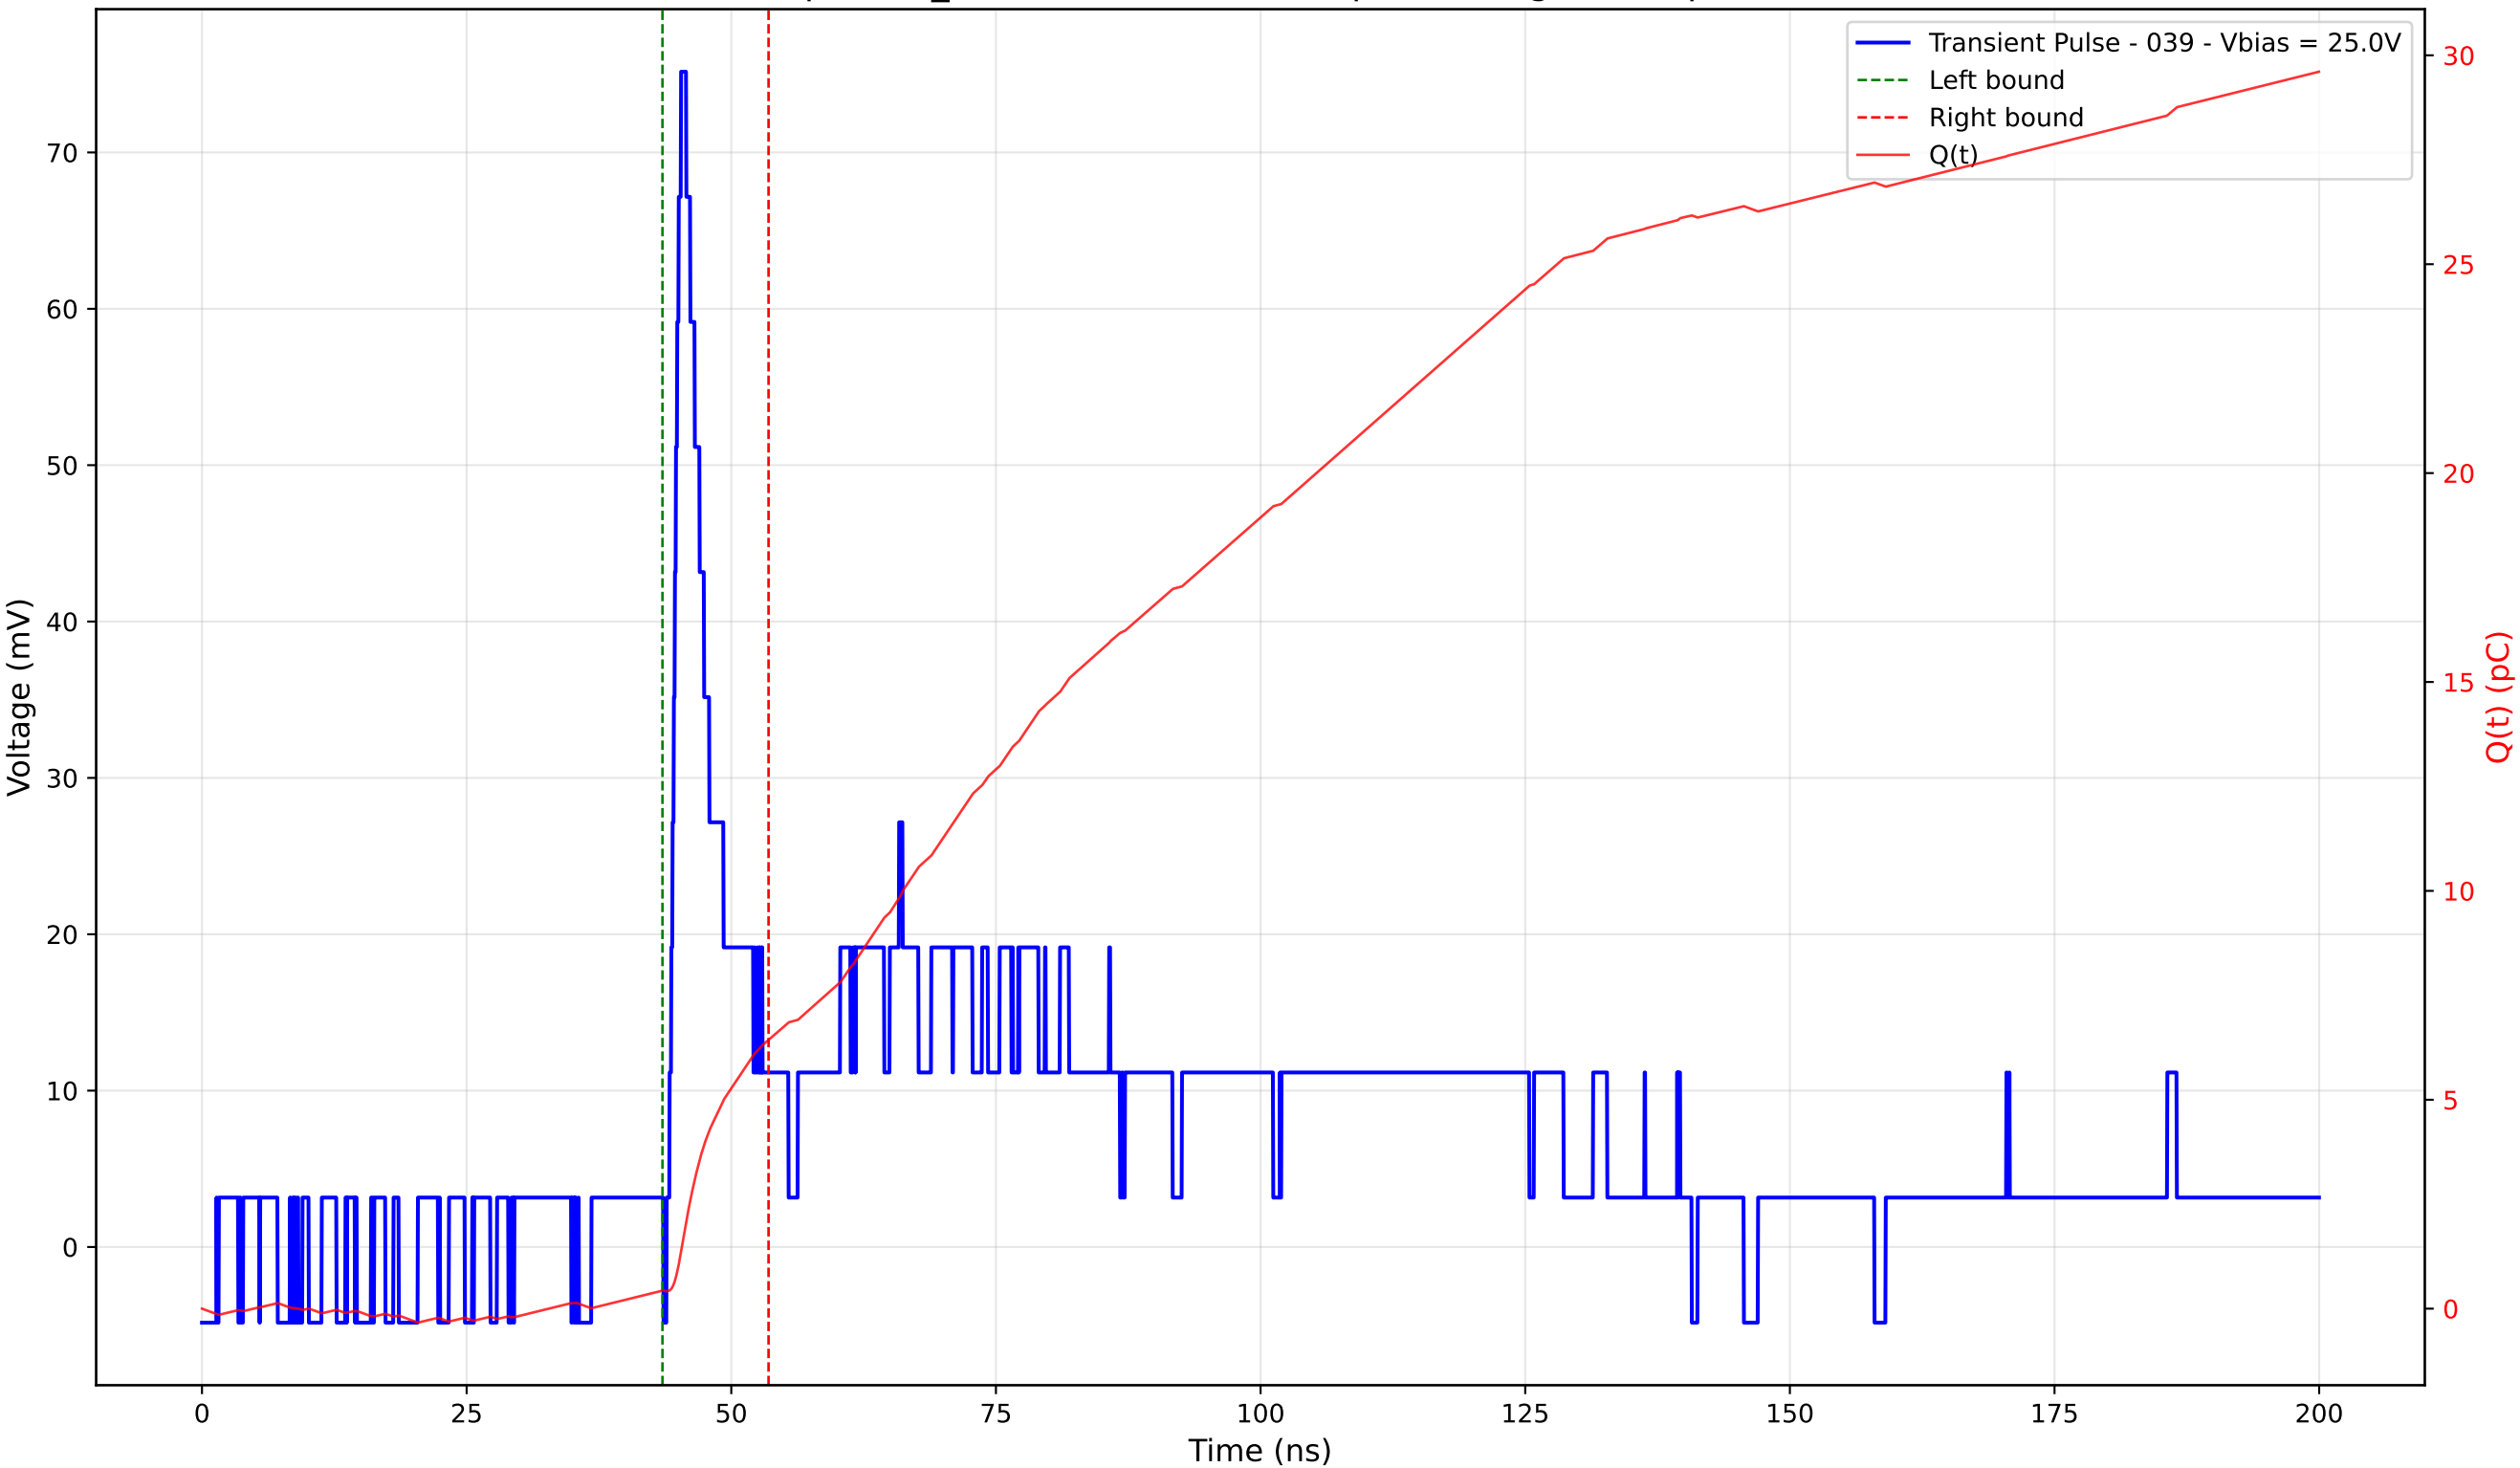


Transient Pulse - Sample: TD_4004 - Position: 345.0 μm - Charge: 6.71 pC - Rise Time: 0.95 ns

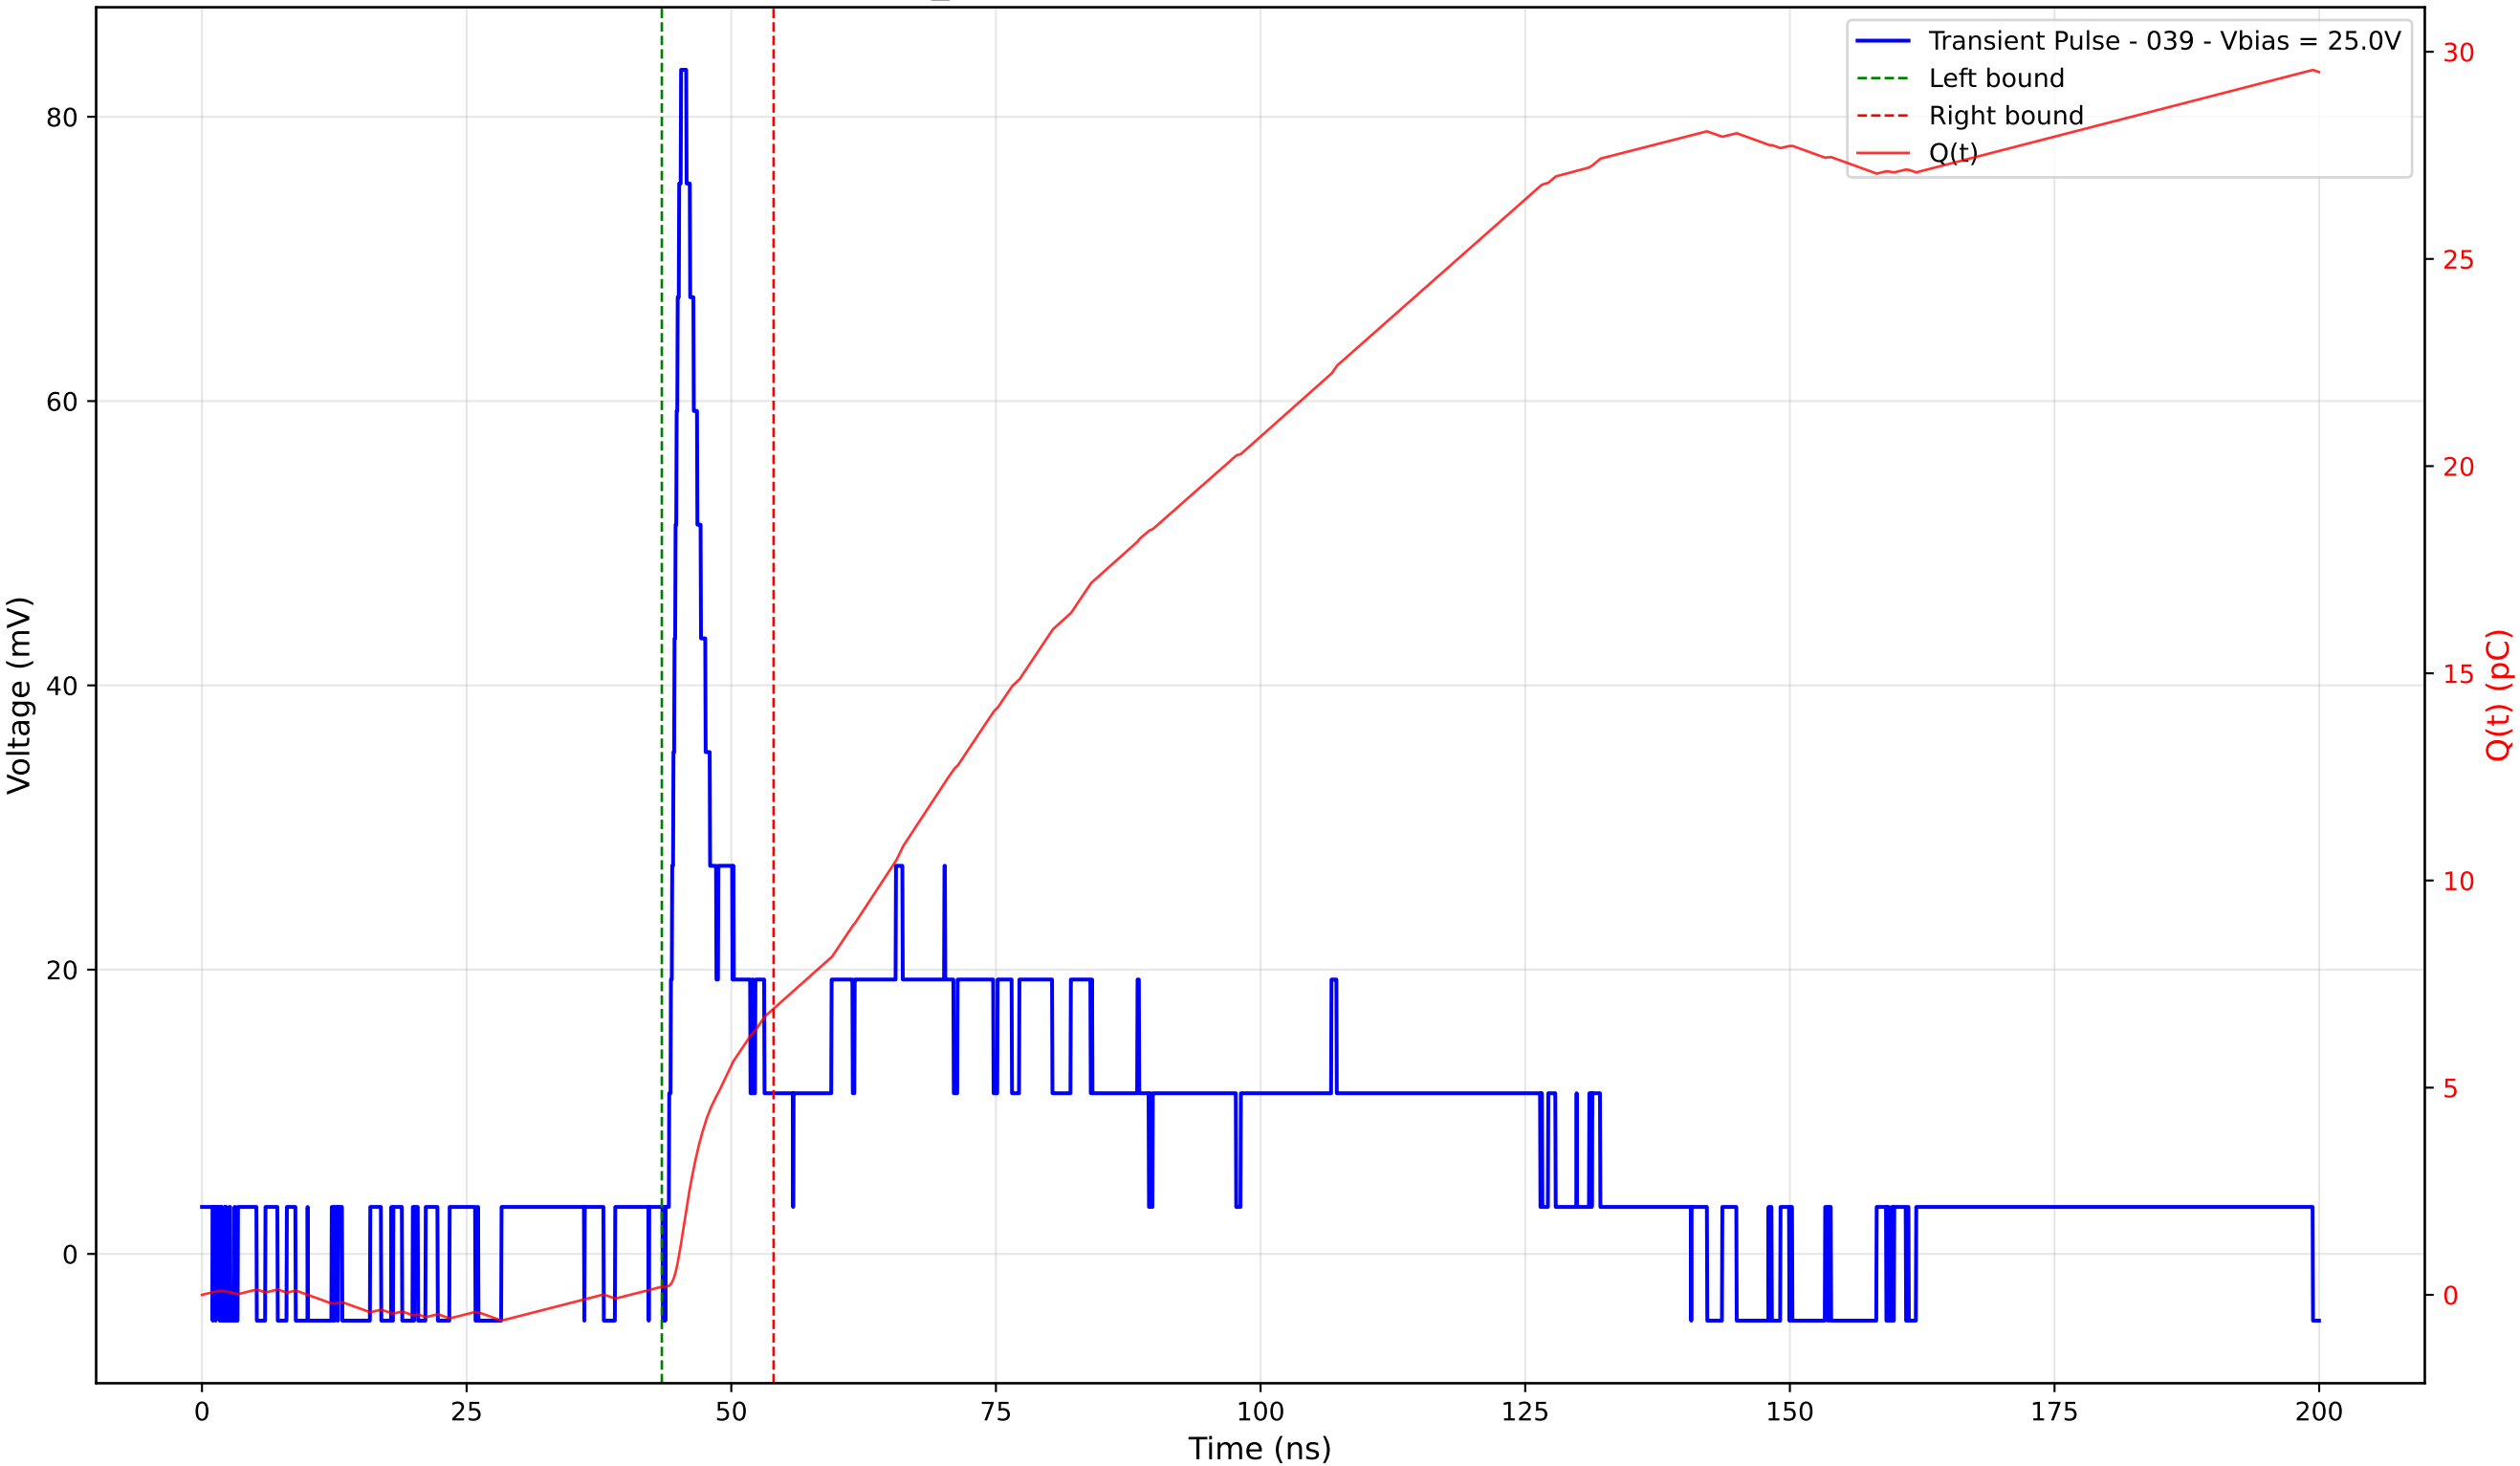


Transient Pulse - Sample: TD_4004 - Position: 350.0 μm - Charge: 25.51 pC - Rise Time: 1.04 ns

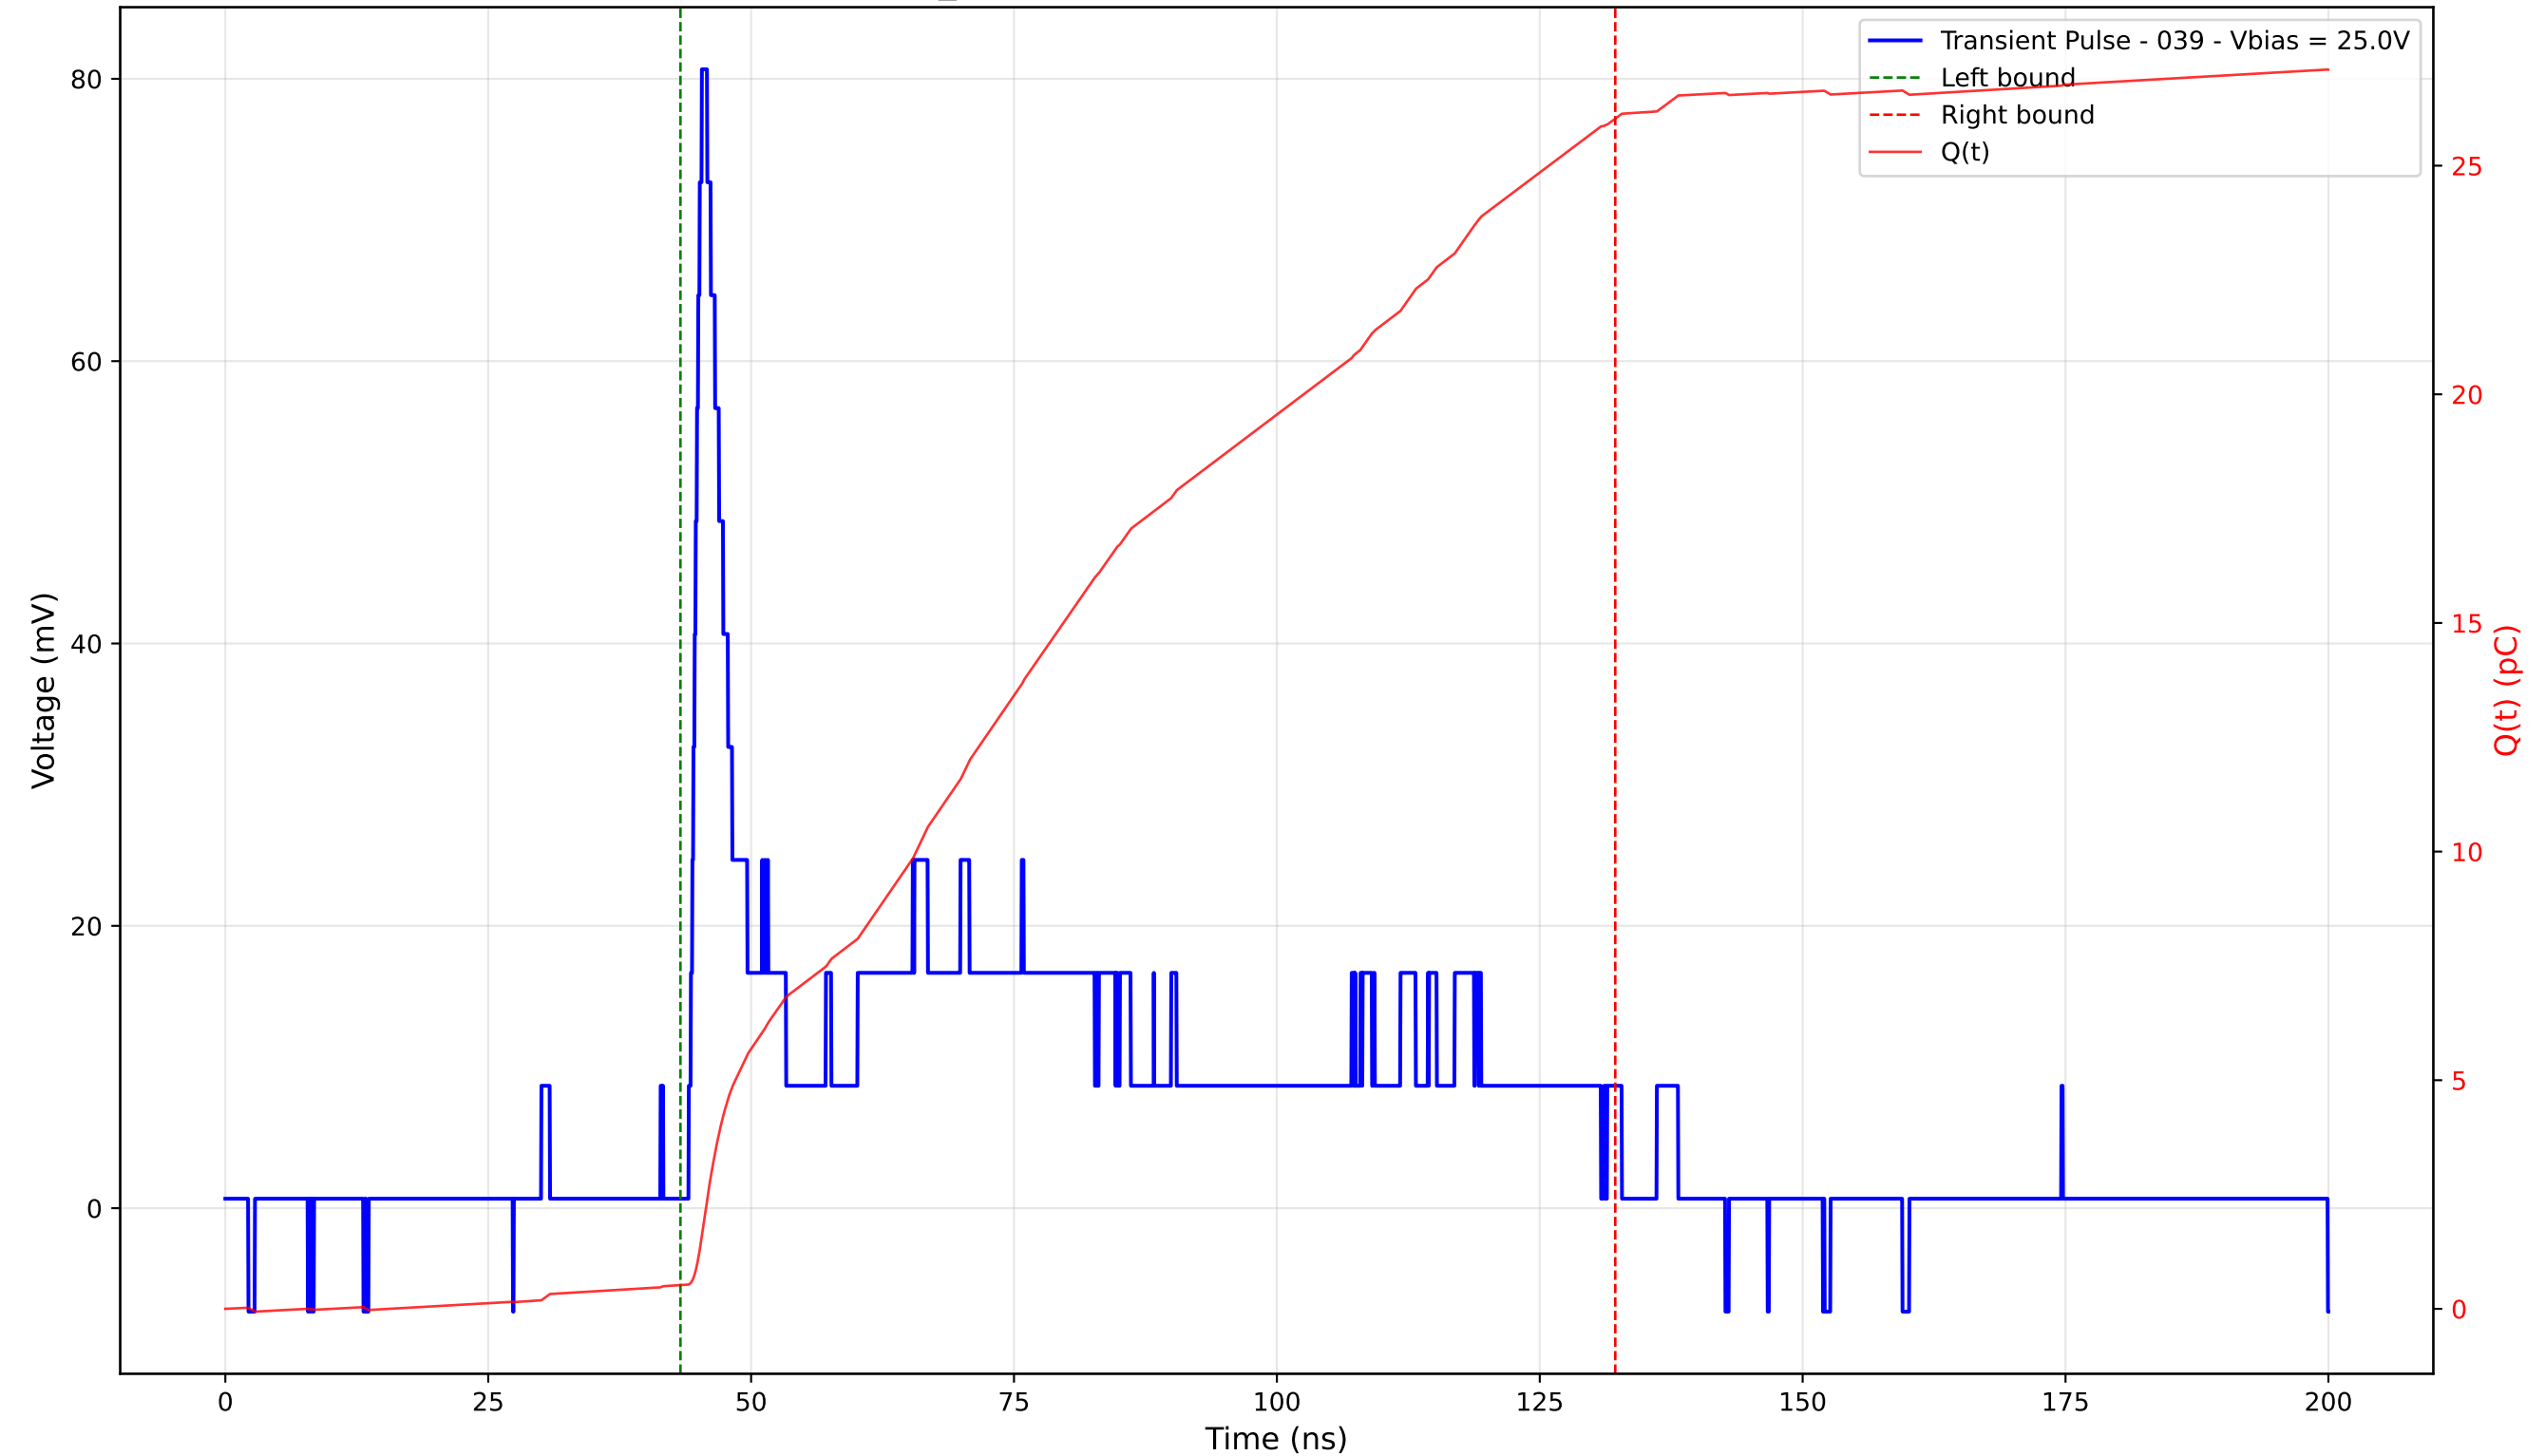


Transient Pulse - Sample: TD_4004 - Position: 355.0 μm - Charge: 19.72 pC - Rise Time: 1.17 ns

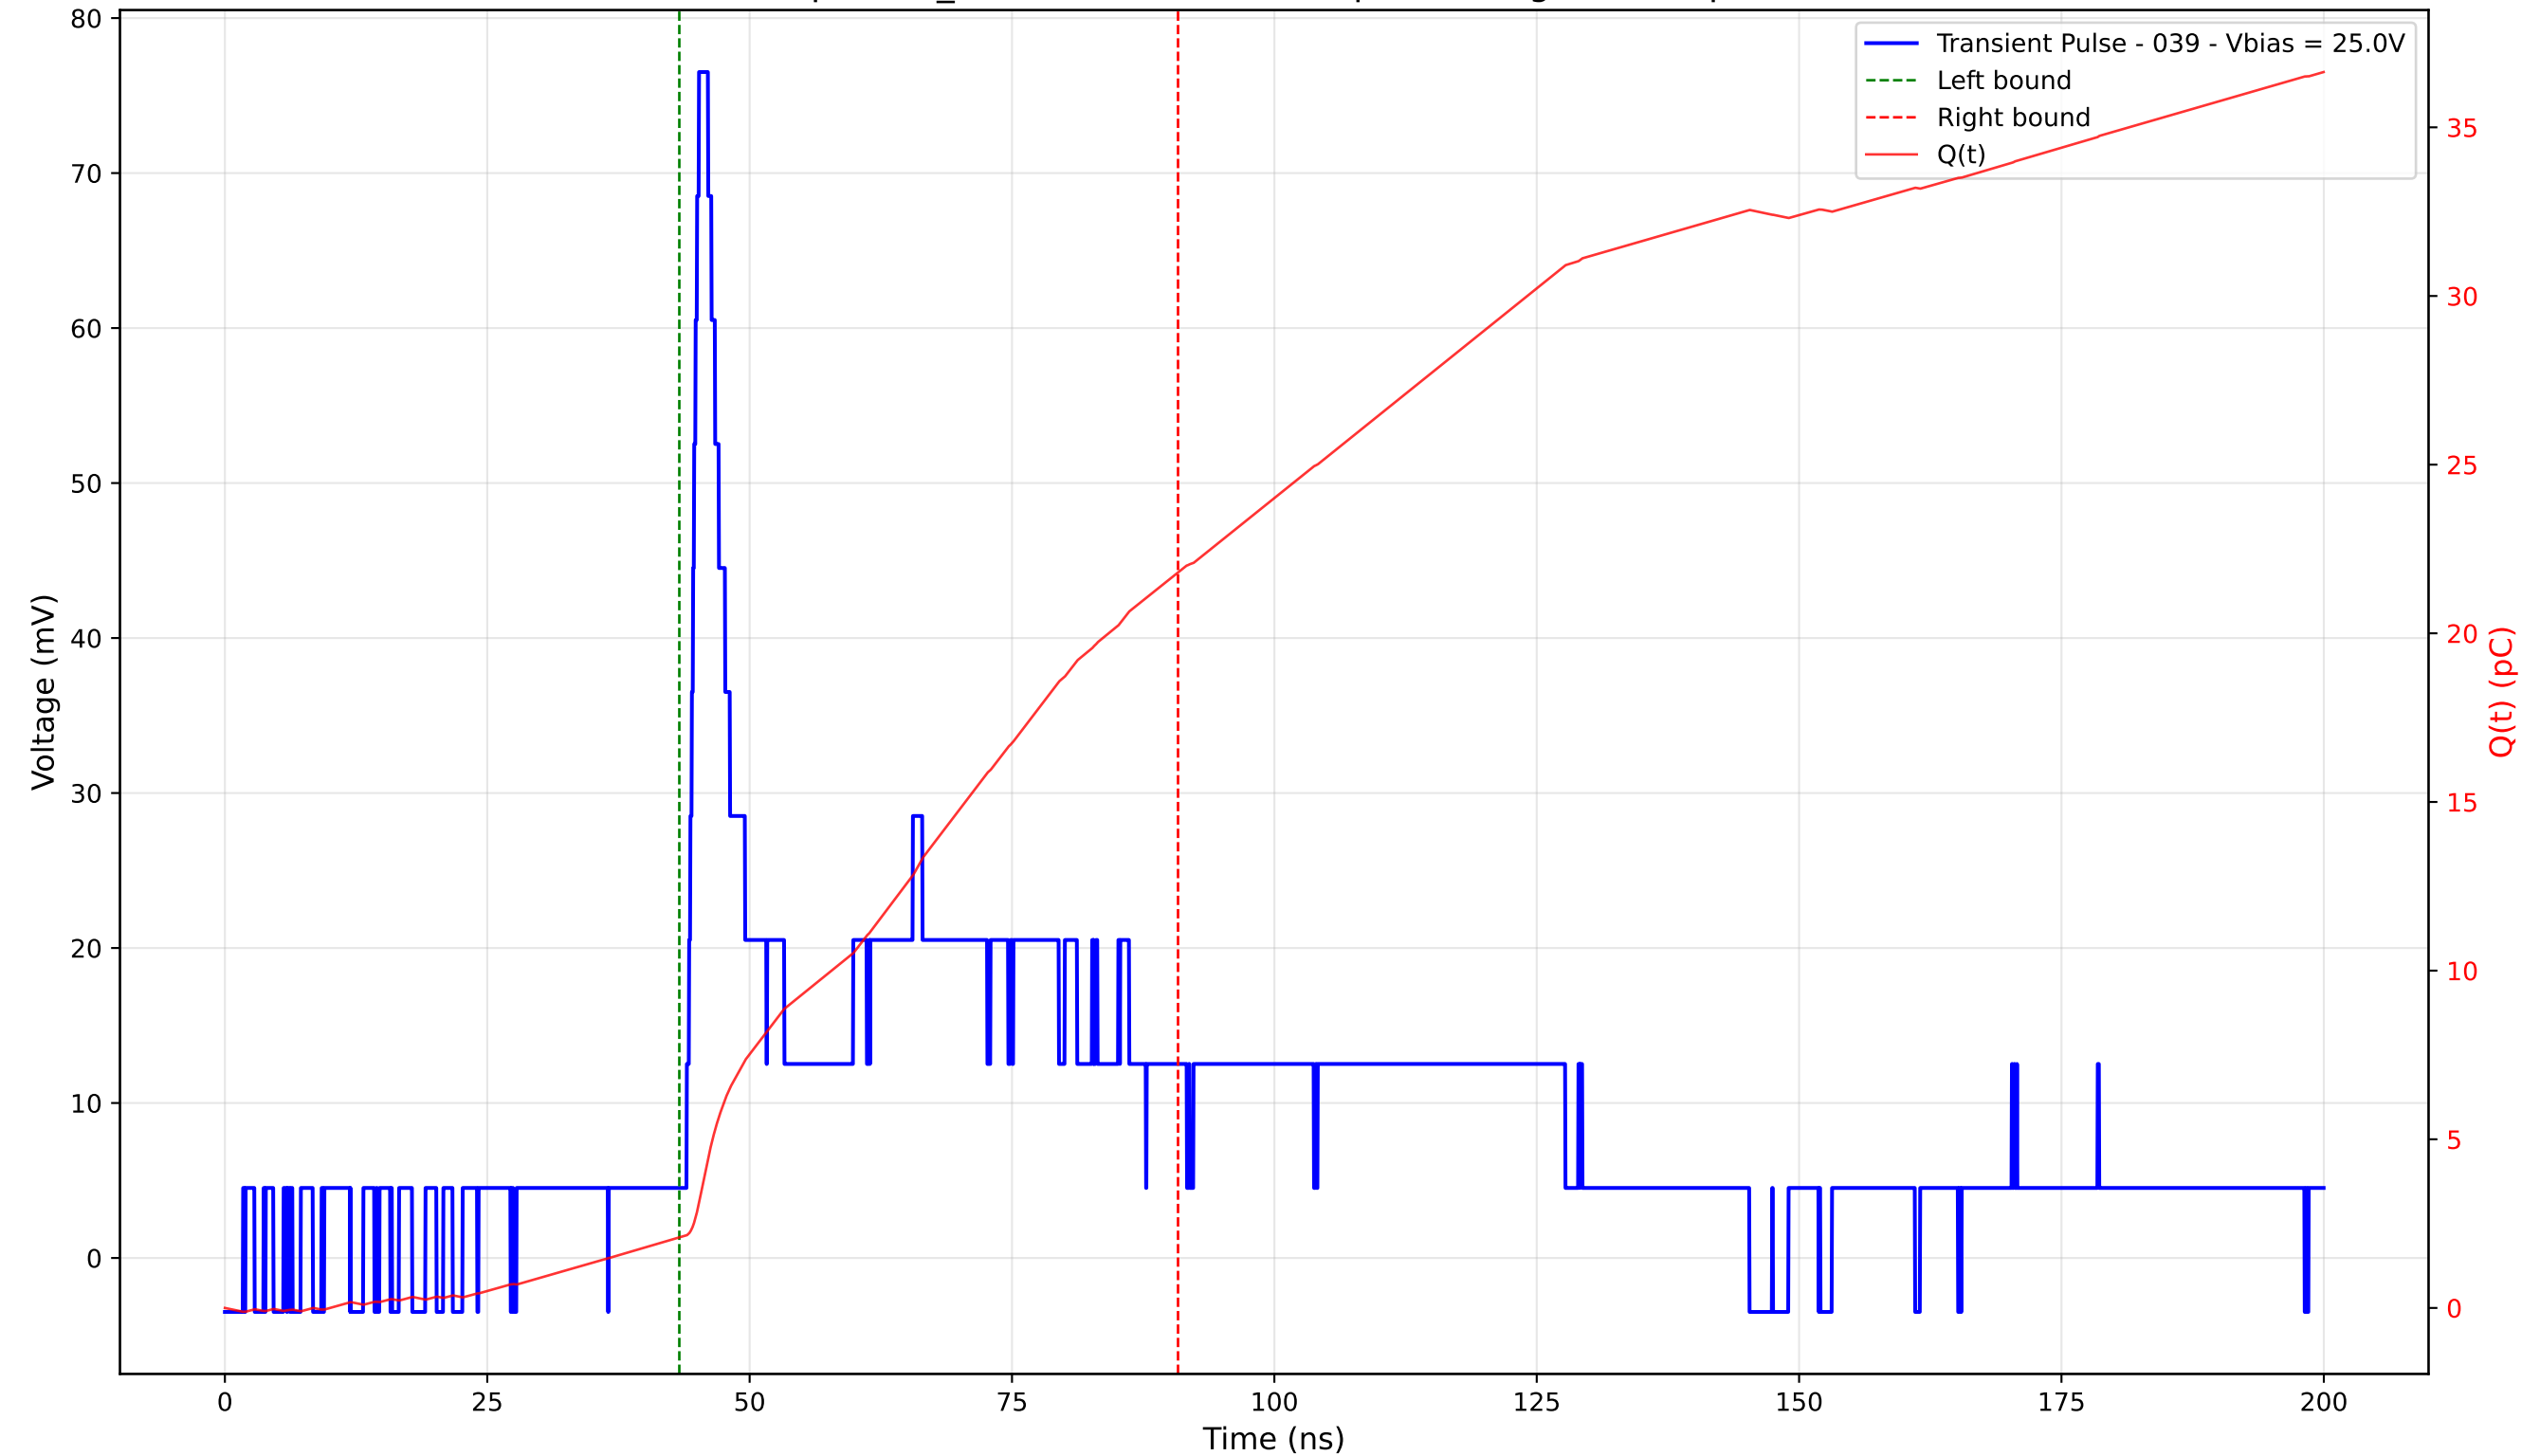


Transient Pulse - Sample: TD_4004 - Position: 360.0 μm - Charge: 6.71 pC - Rise Time: 1.27 ns

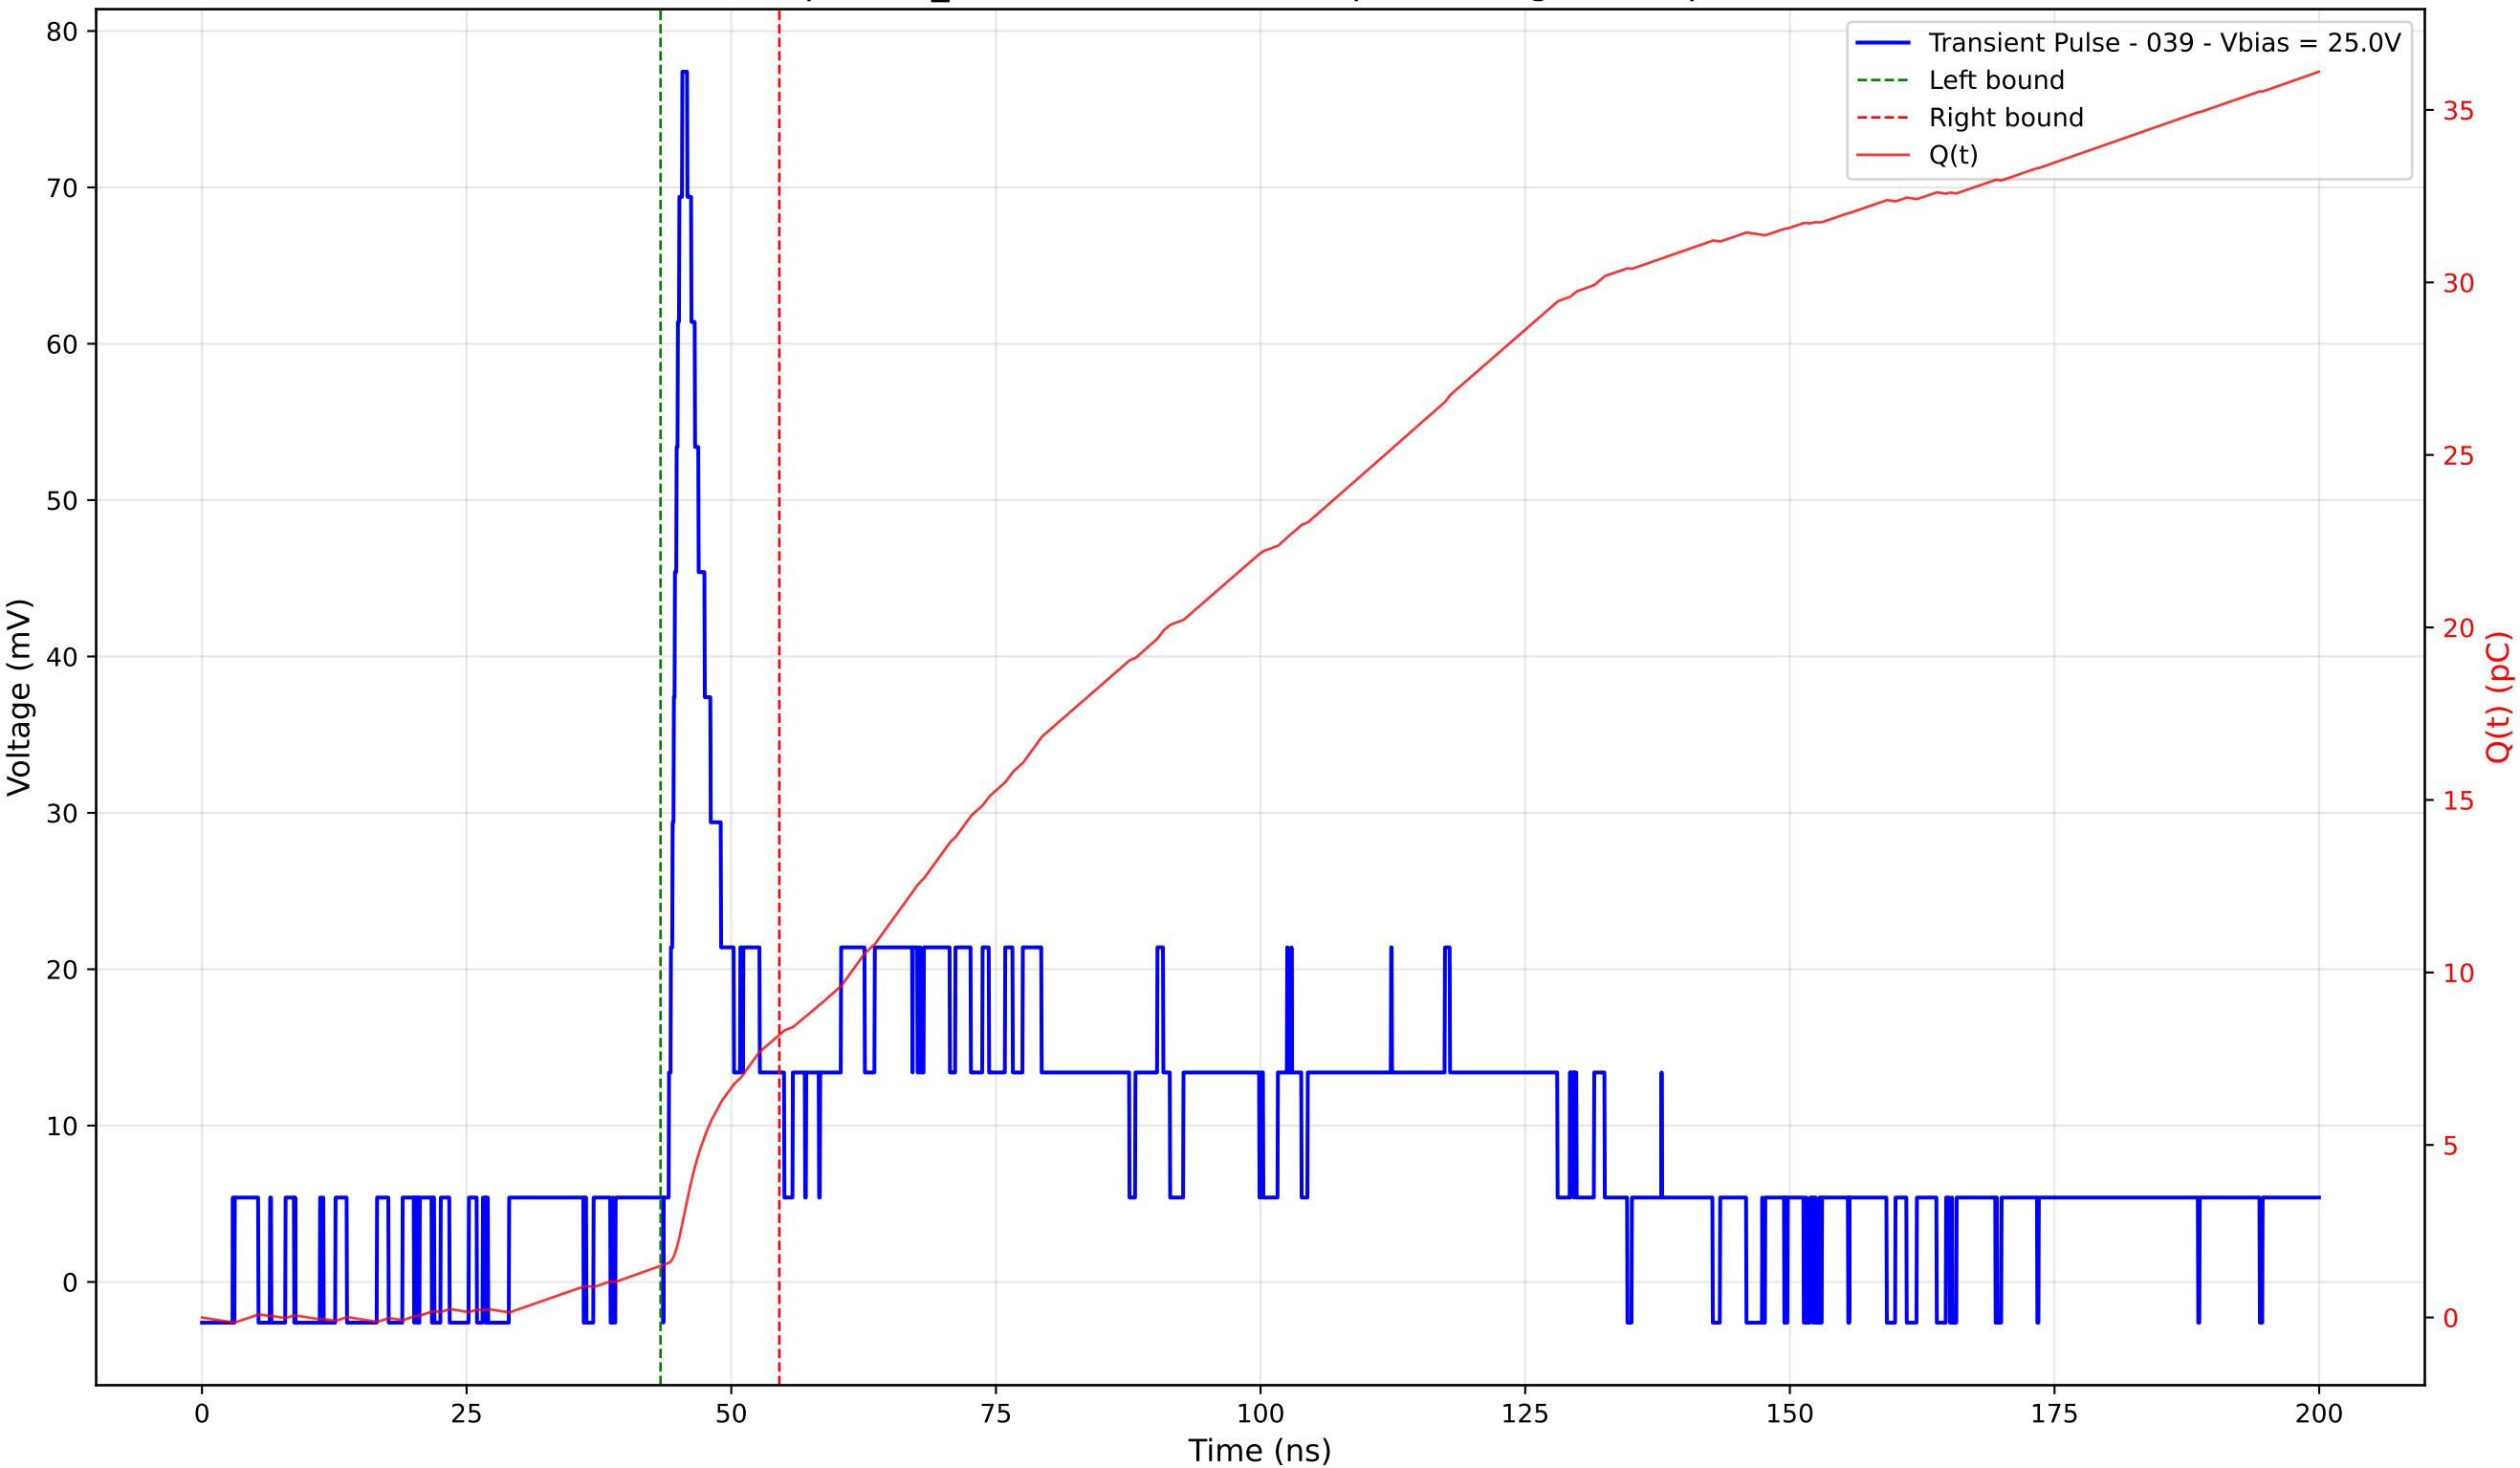


Transient Pulse - Sample: TD_4004 - Position: 365.0 μm - Charge: 5.82 pC - Rise Time: 1.17 ns

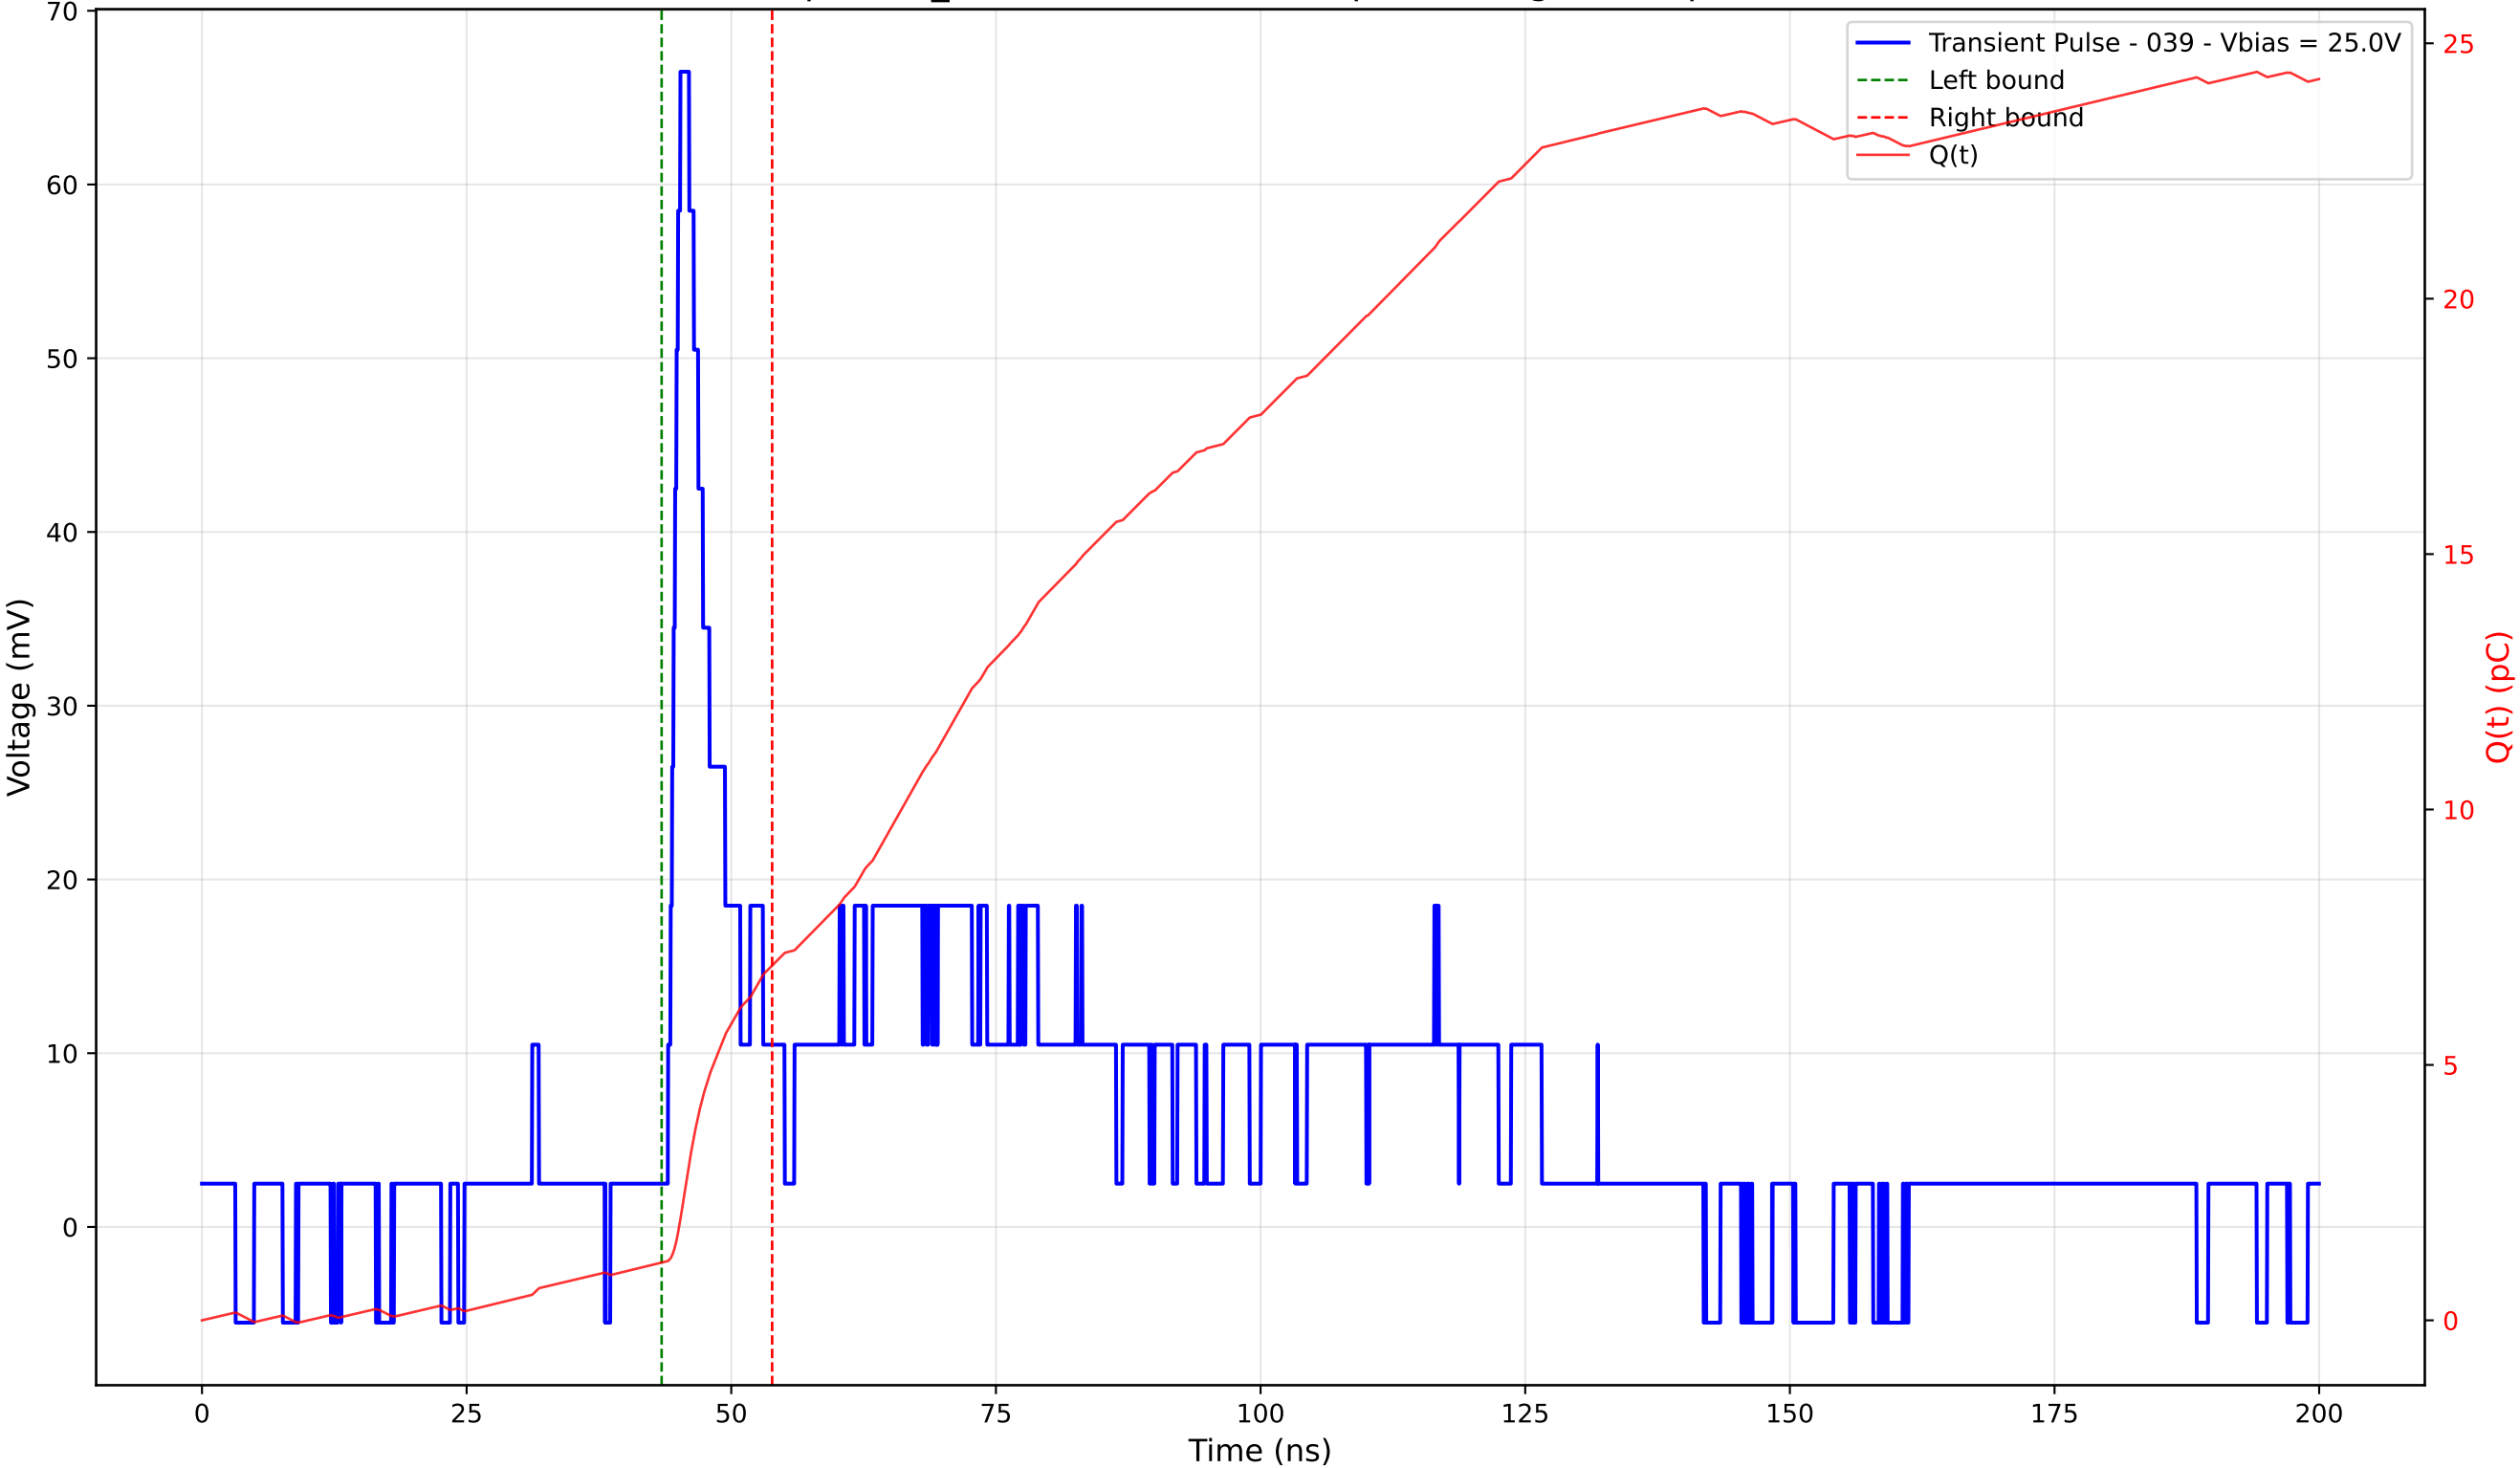


Transient Pulse - Sample: TD_4004 - Position: 370.0 μm - Charge: 4.83 pC - Rise Time: 0.93 ns

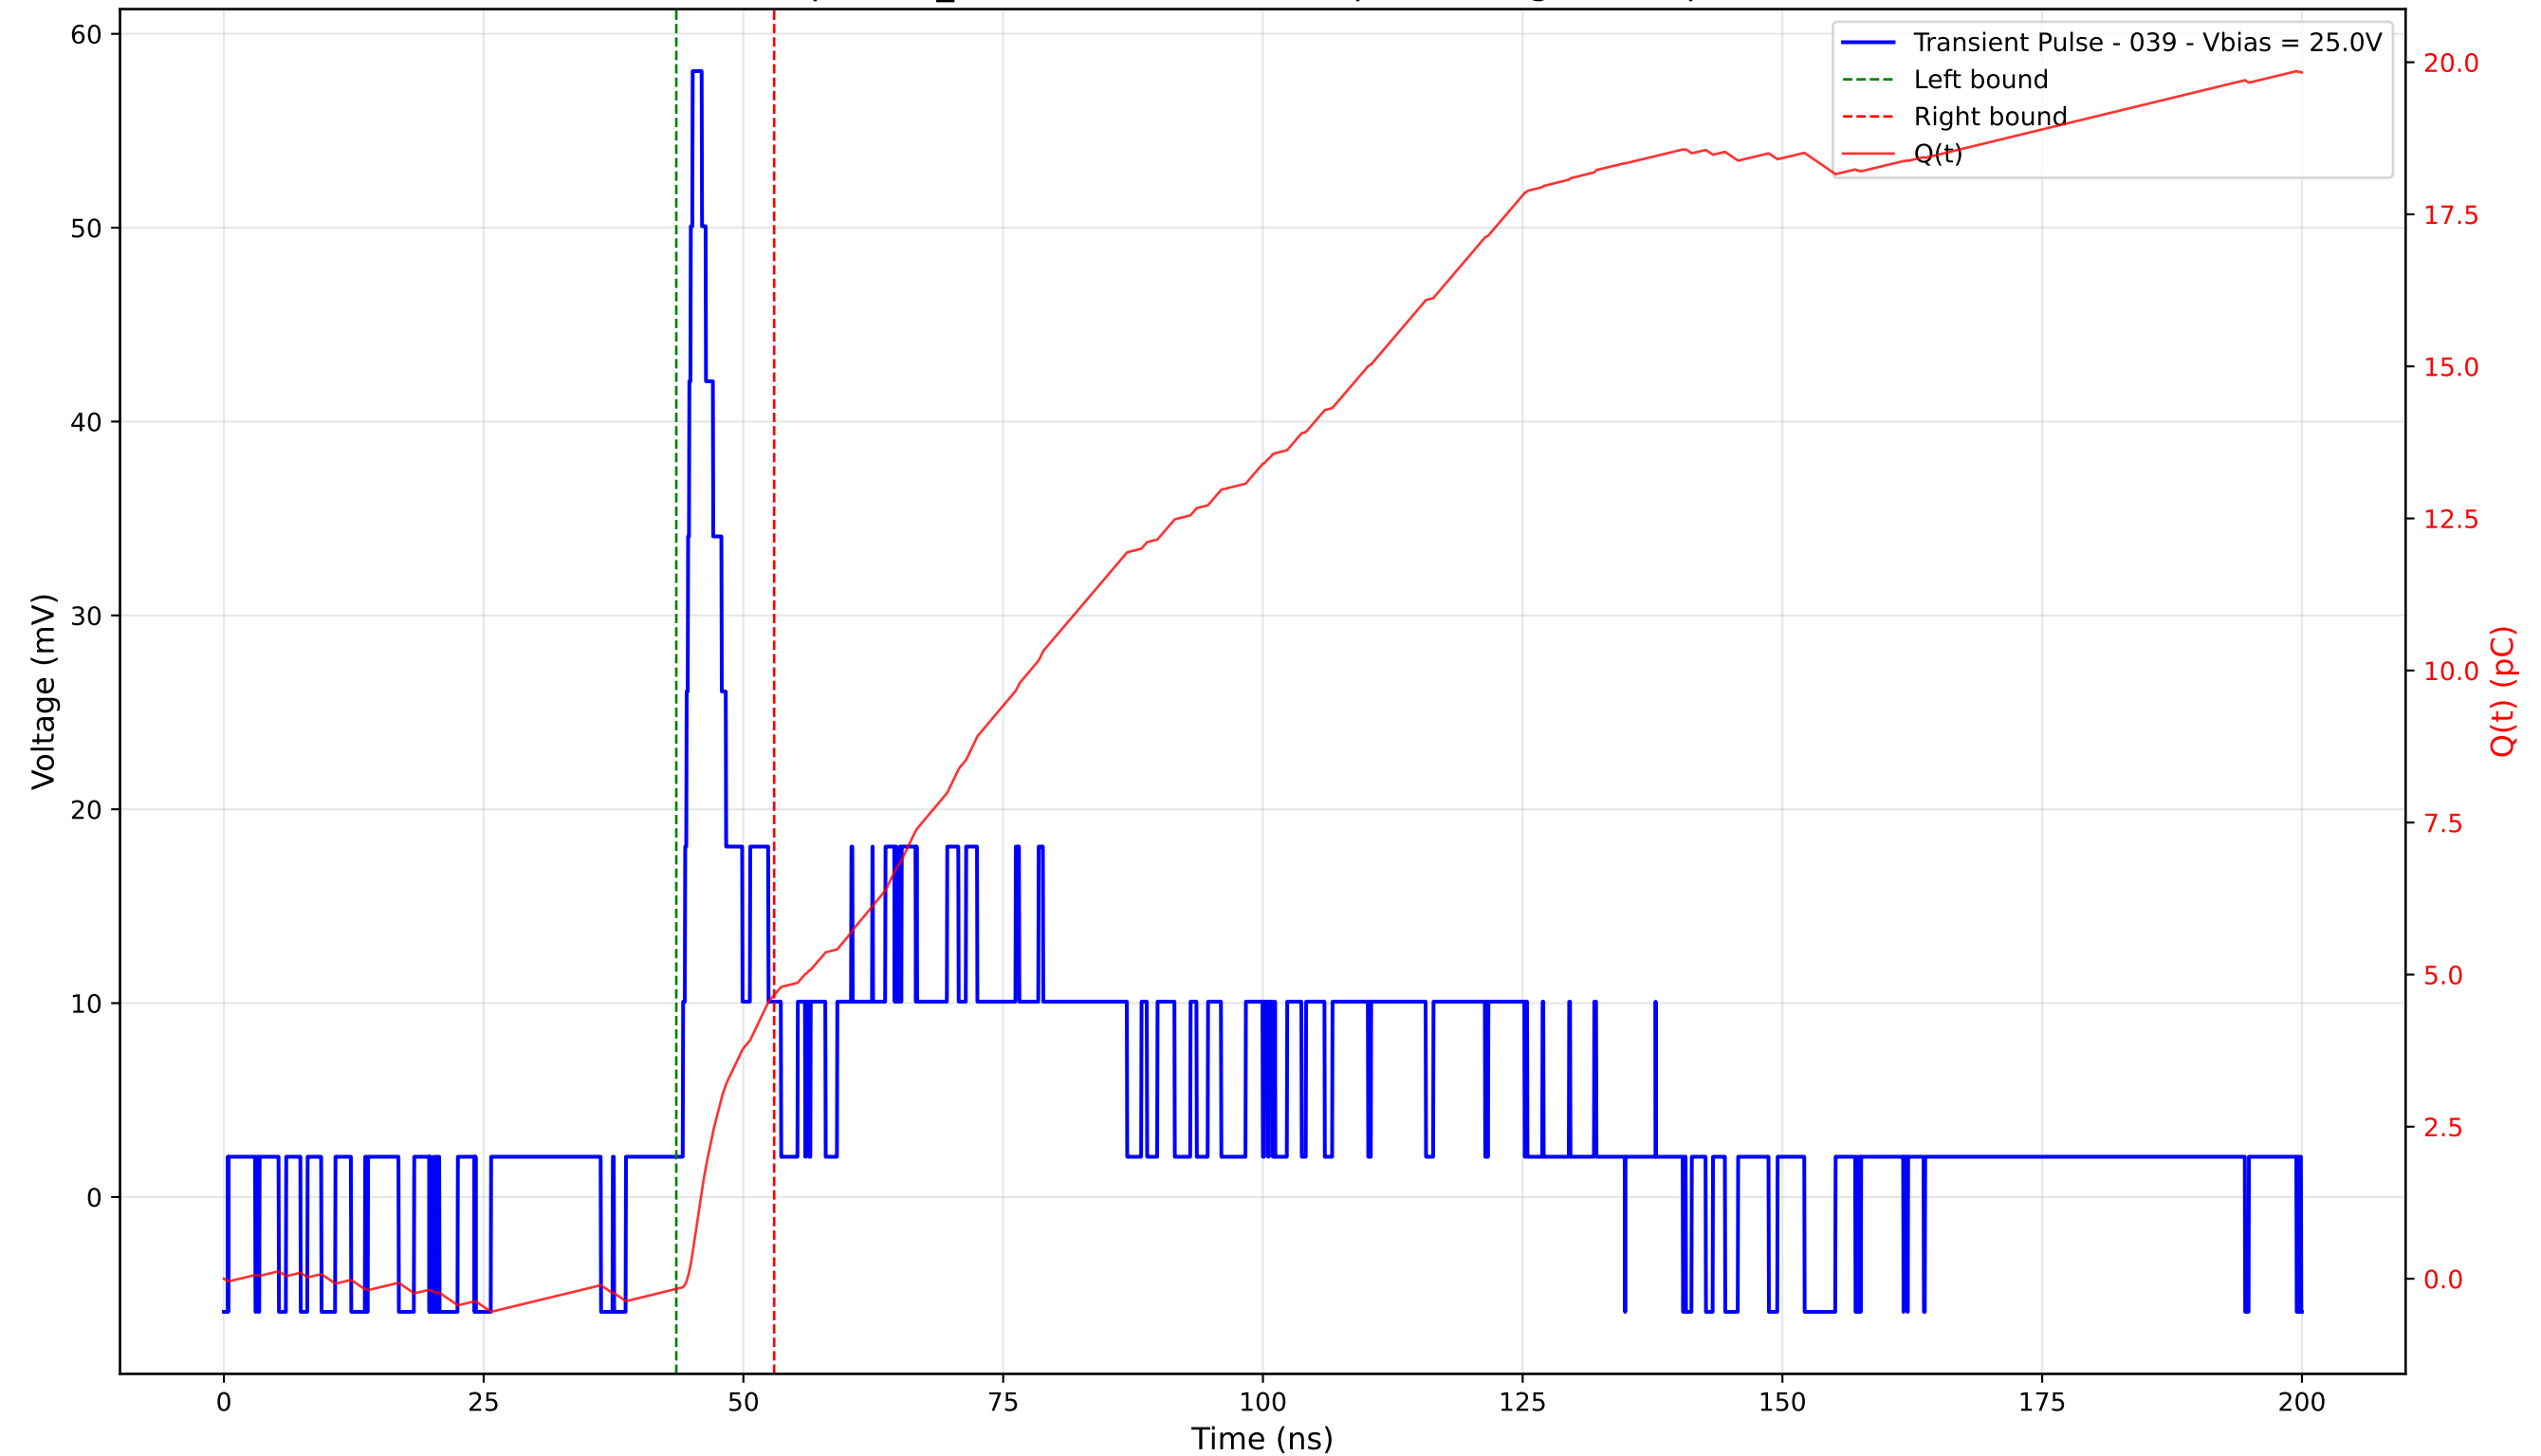


Transient Pulse - Sample: TD_4004 - Position: 375.0 μm - Charge: 5.64 pC - Rise Time: 1.11 ns

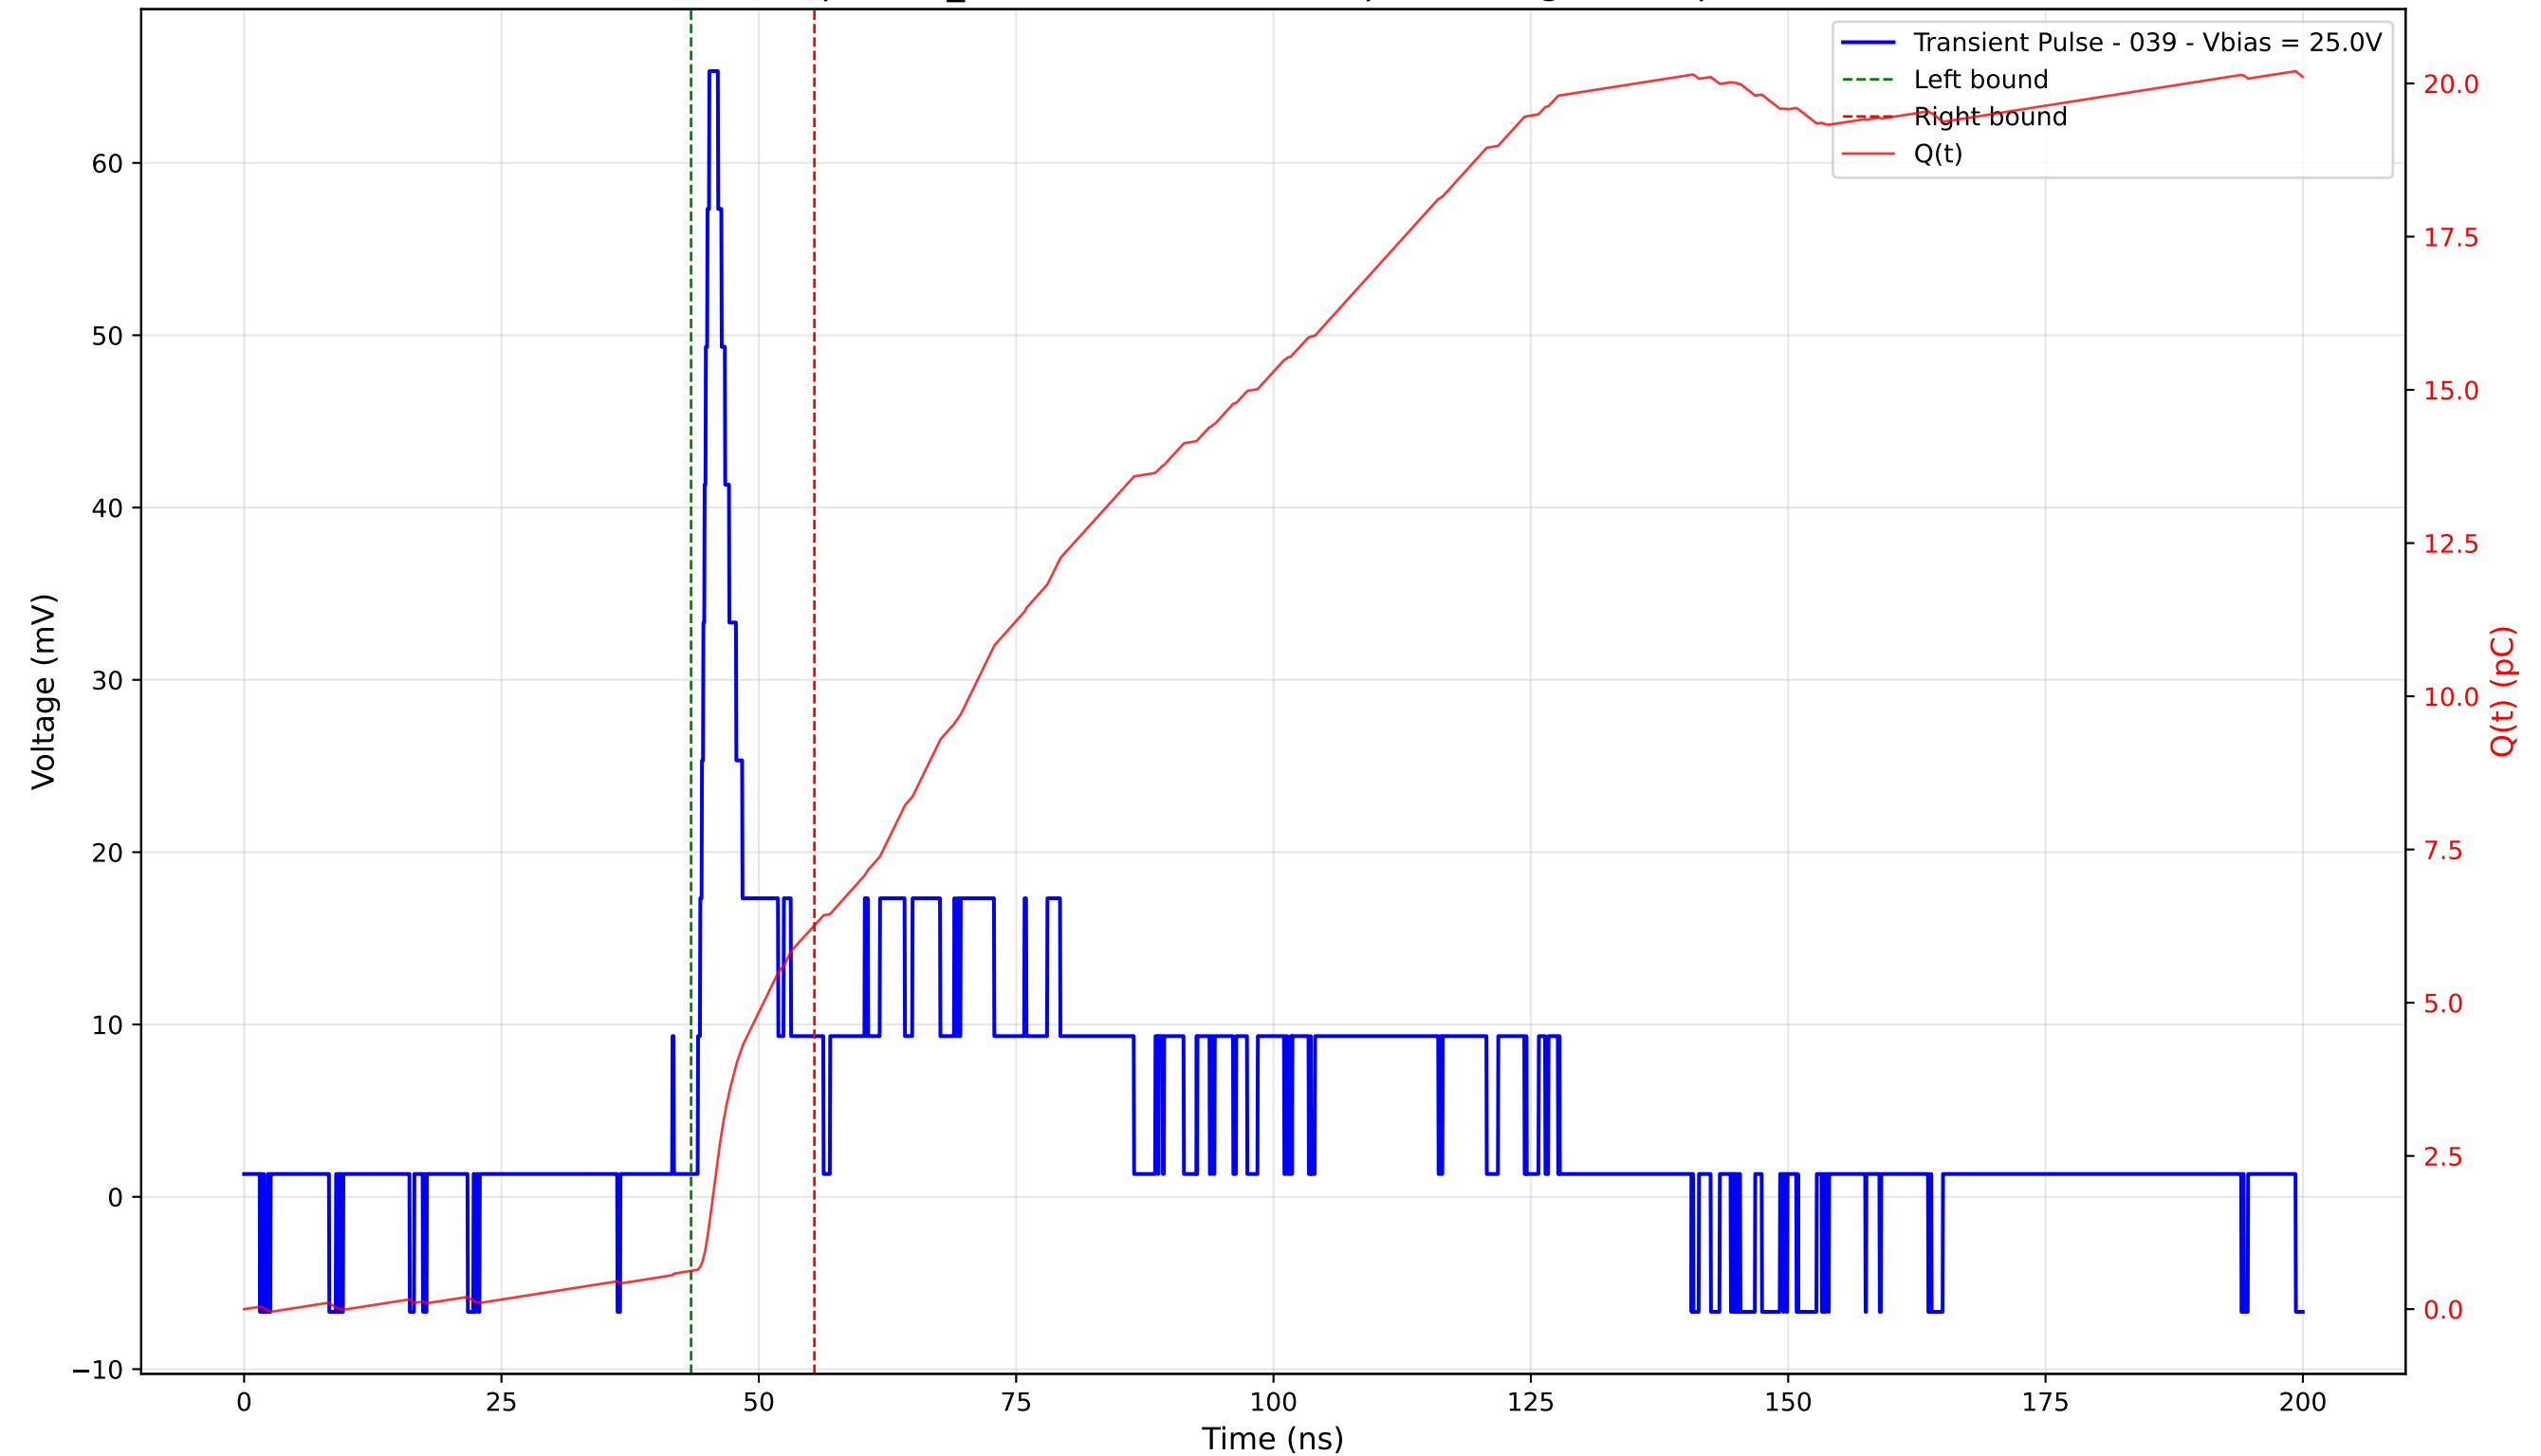


Transient Pulse - Sample: TD_4004 - Position: 380.0 μm - Charge: 15.10 pC - Rise Time: 1.42 ns

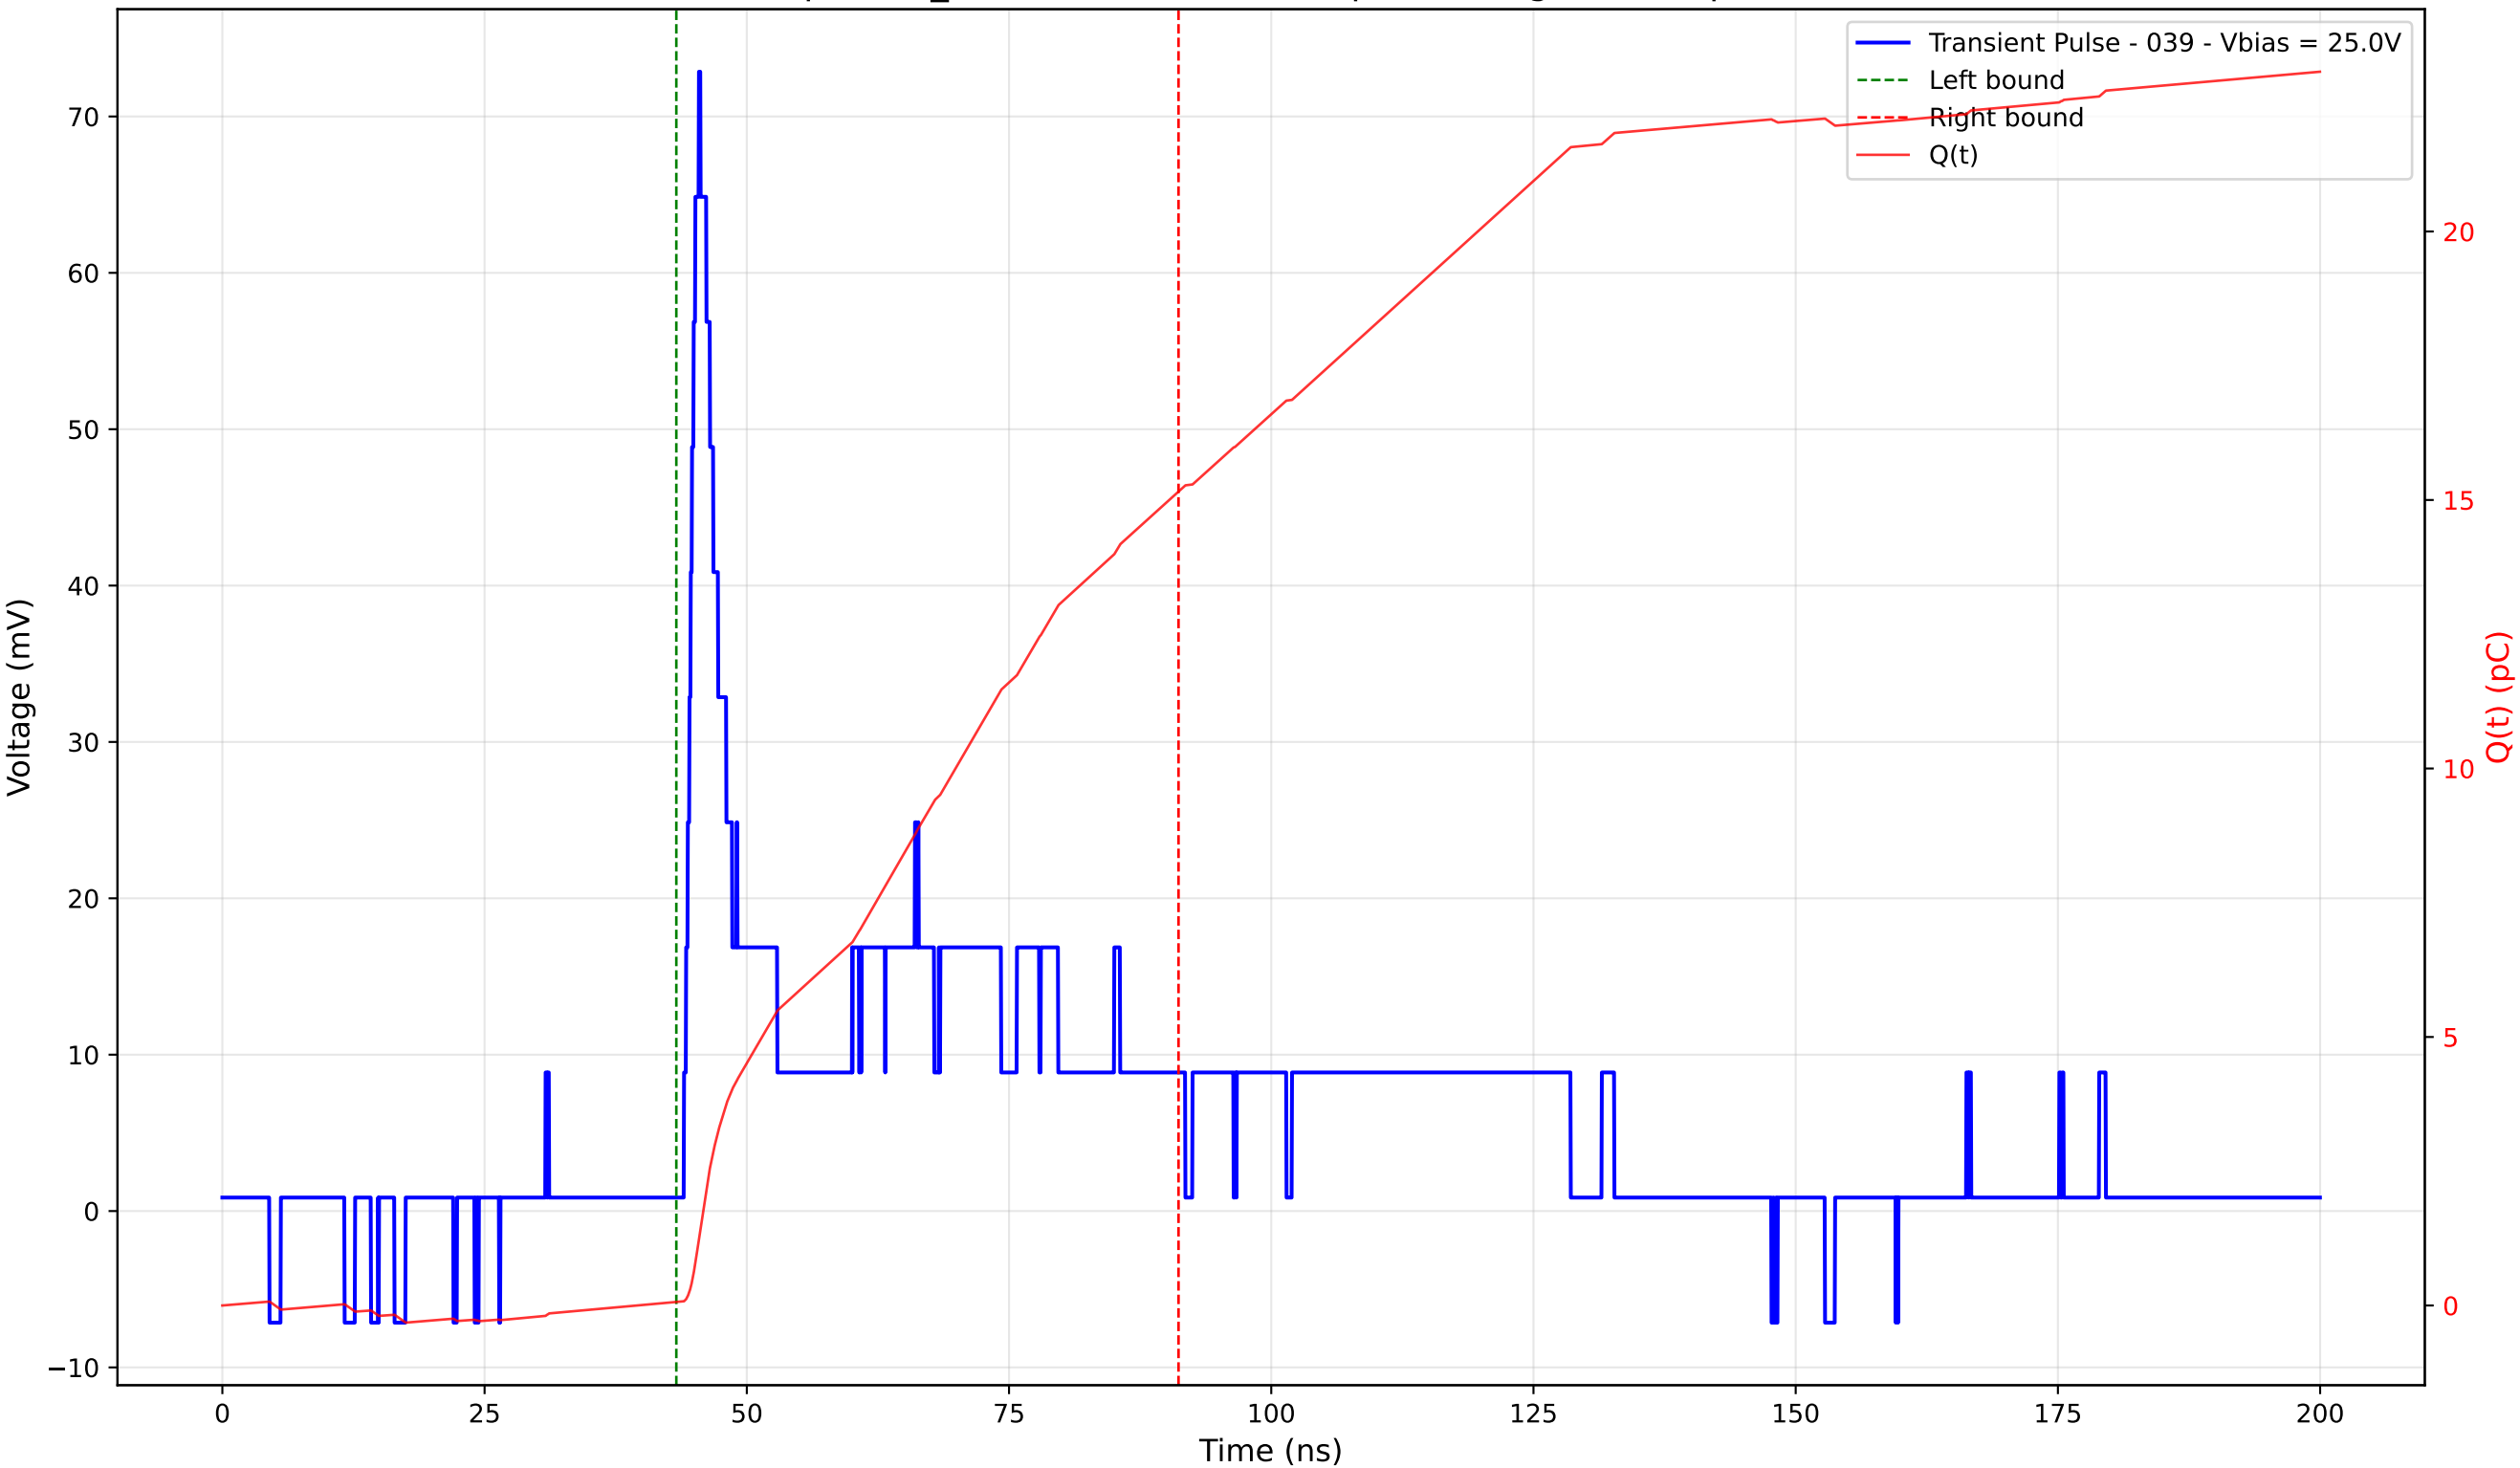


Transient Pulse - Sample: TD_4004 - Position: 385.0 μm - Charge: 5.06 pC - Rise Time: 1.15 ns

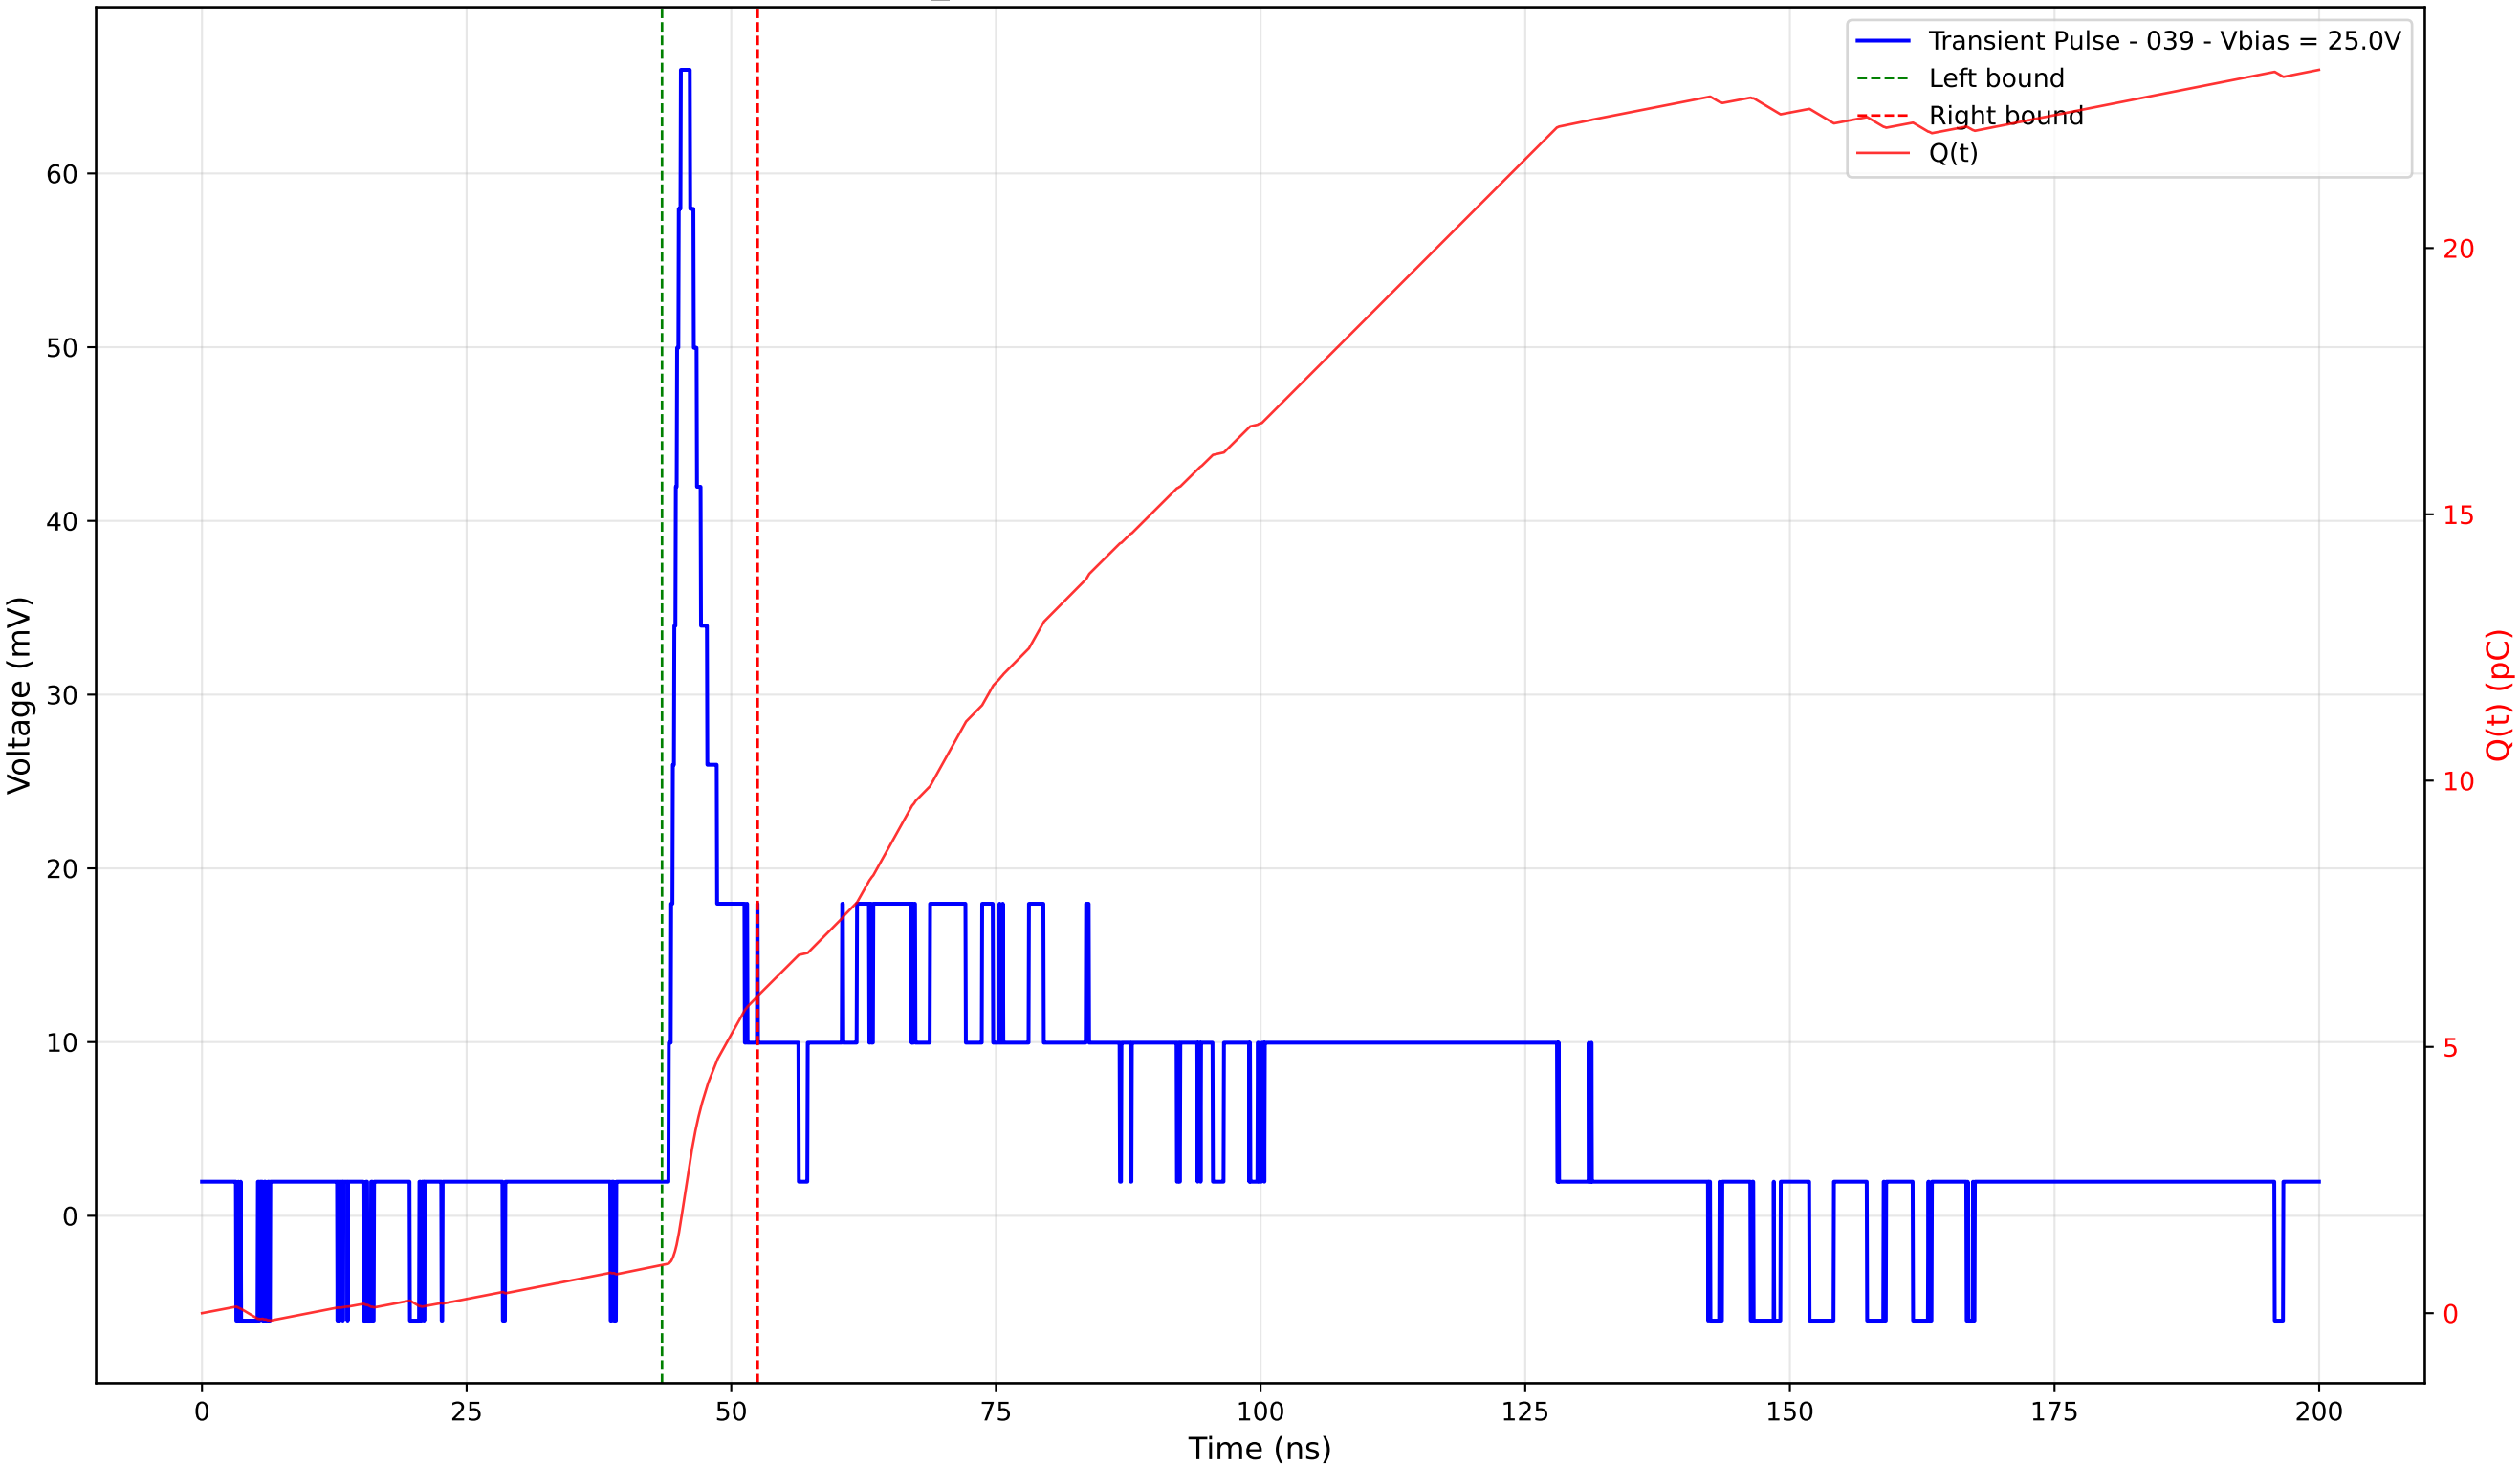


Transient Pulse - Sample: TD_4004 - Position: 390.0 μm - Charge: 9.97 pC - Rise Time: 1.03 ns

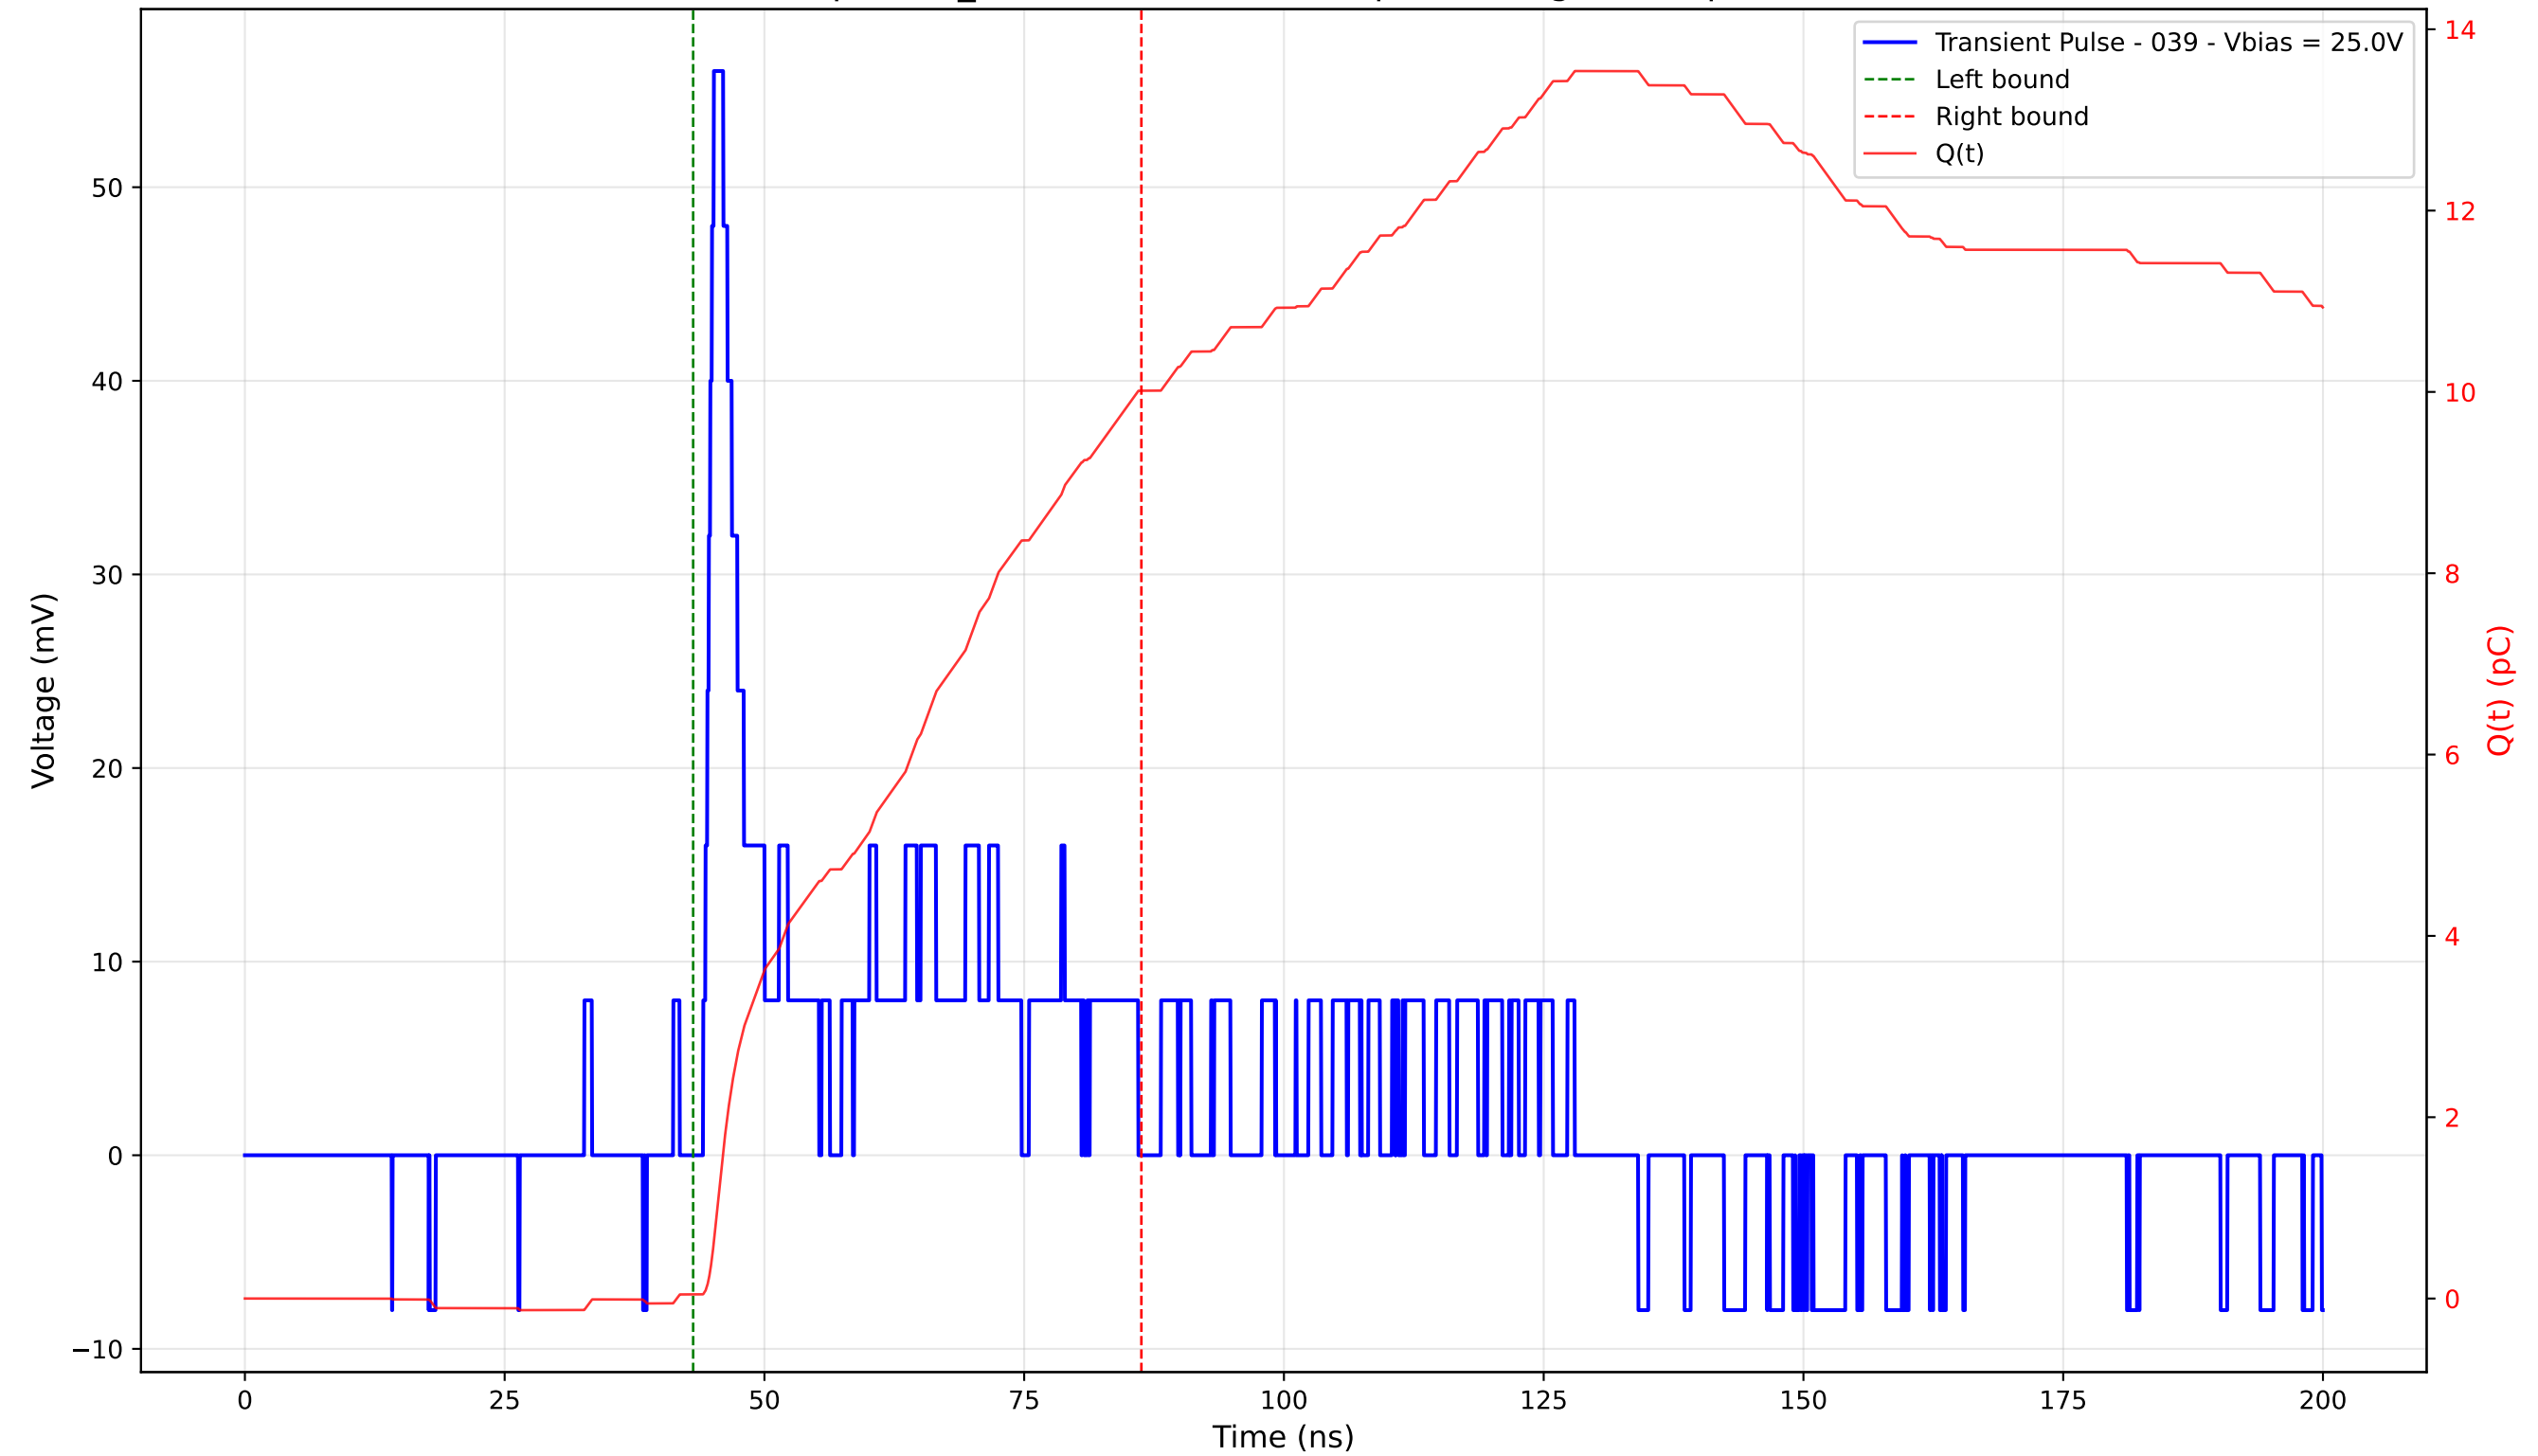


Transient Pulse - Sample: TD_4004 - Position: 395.0 μm - Charge: 3.67 pC - Rise Time: 0.91 ns

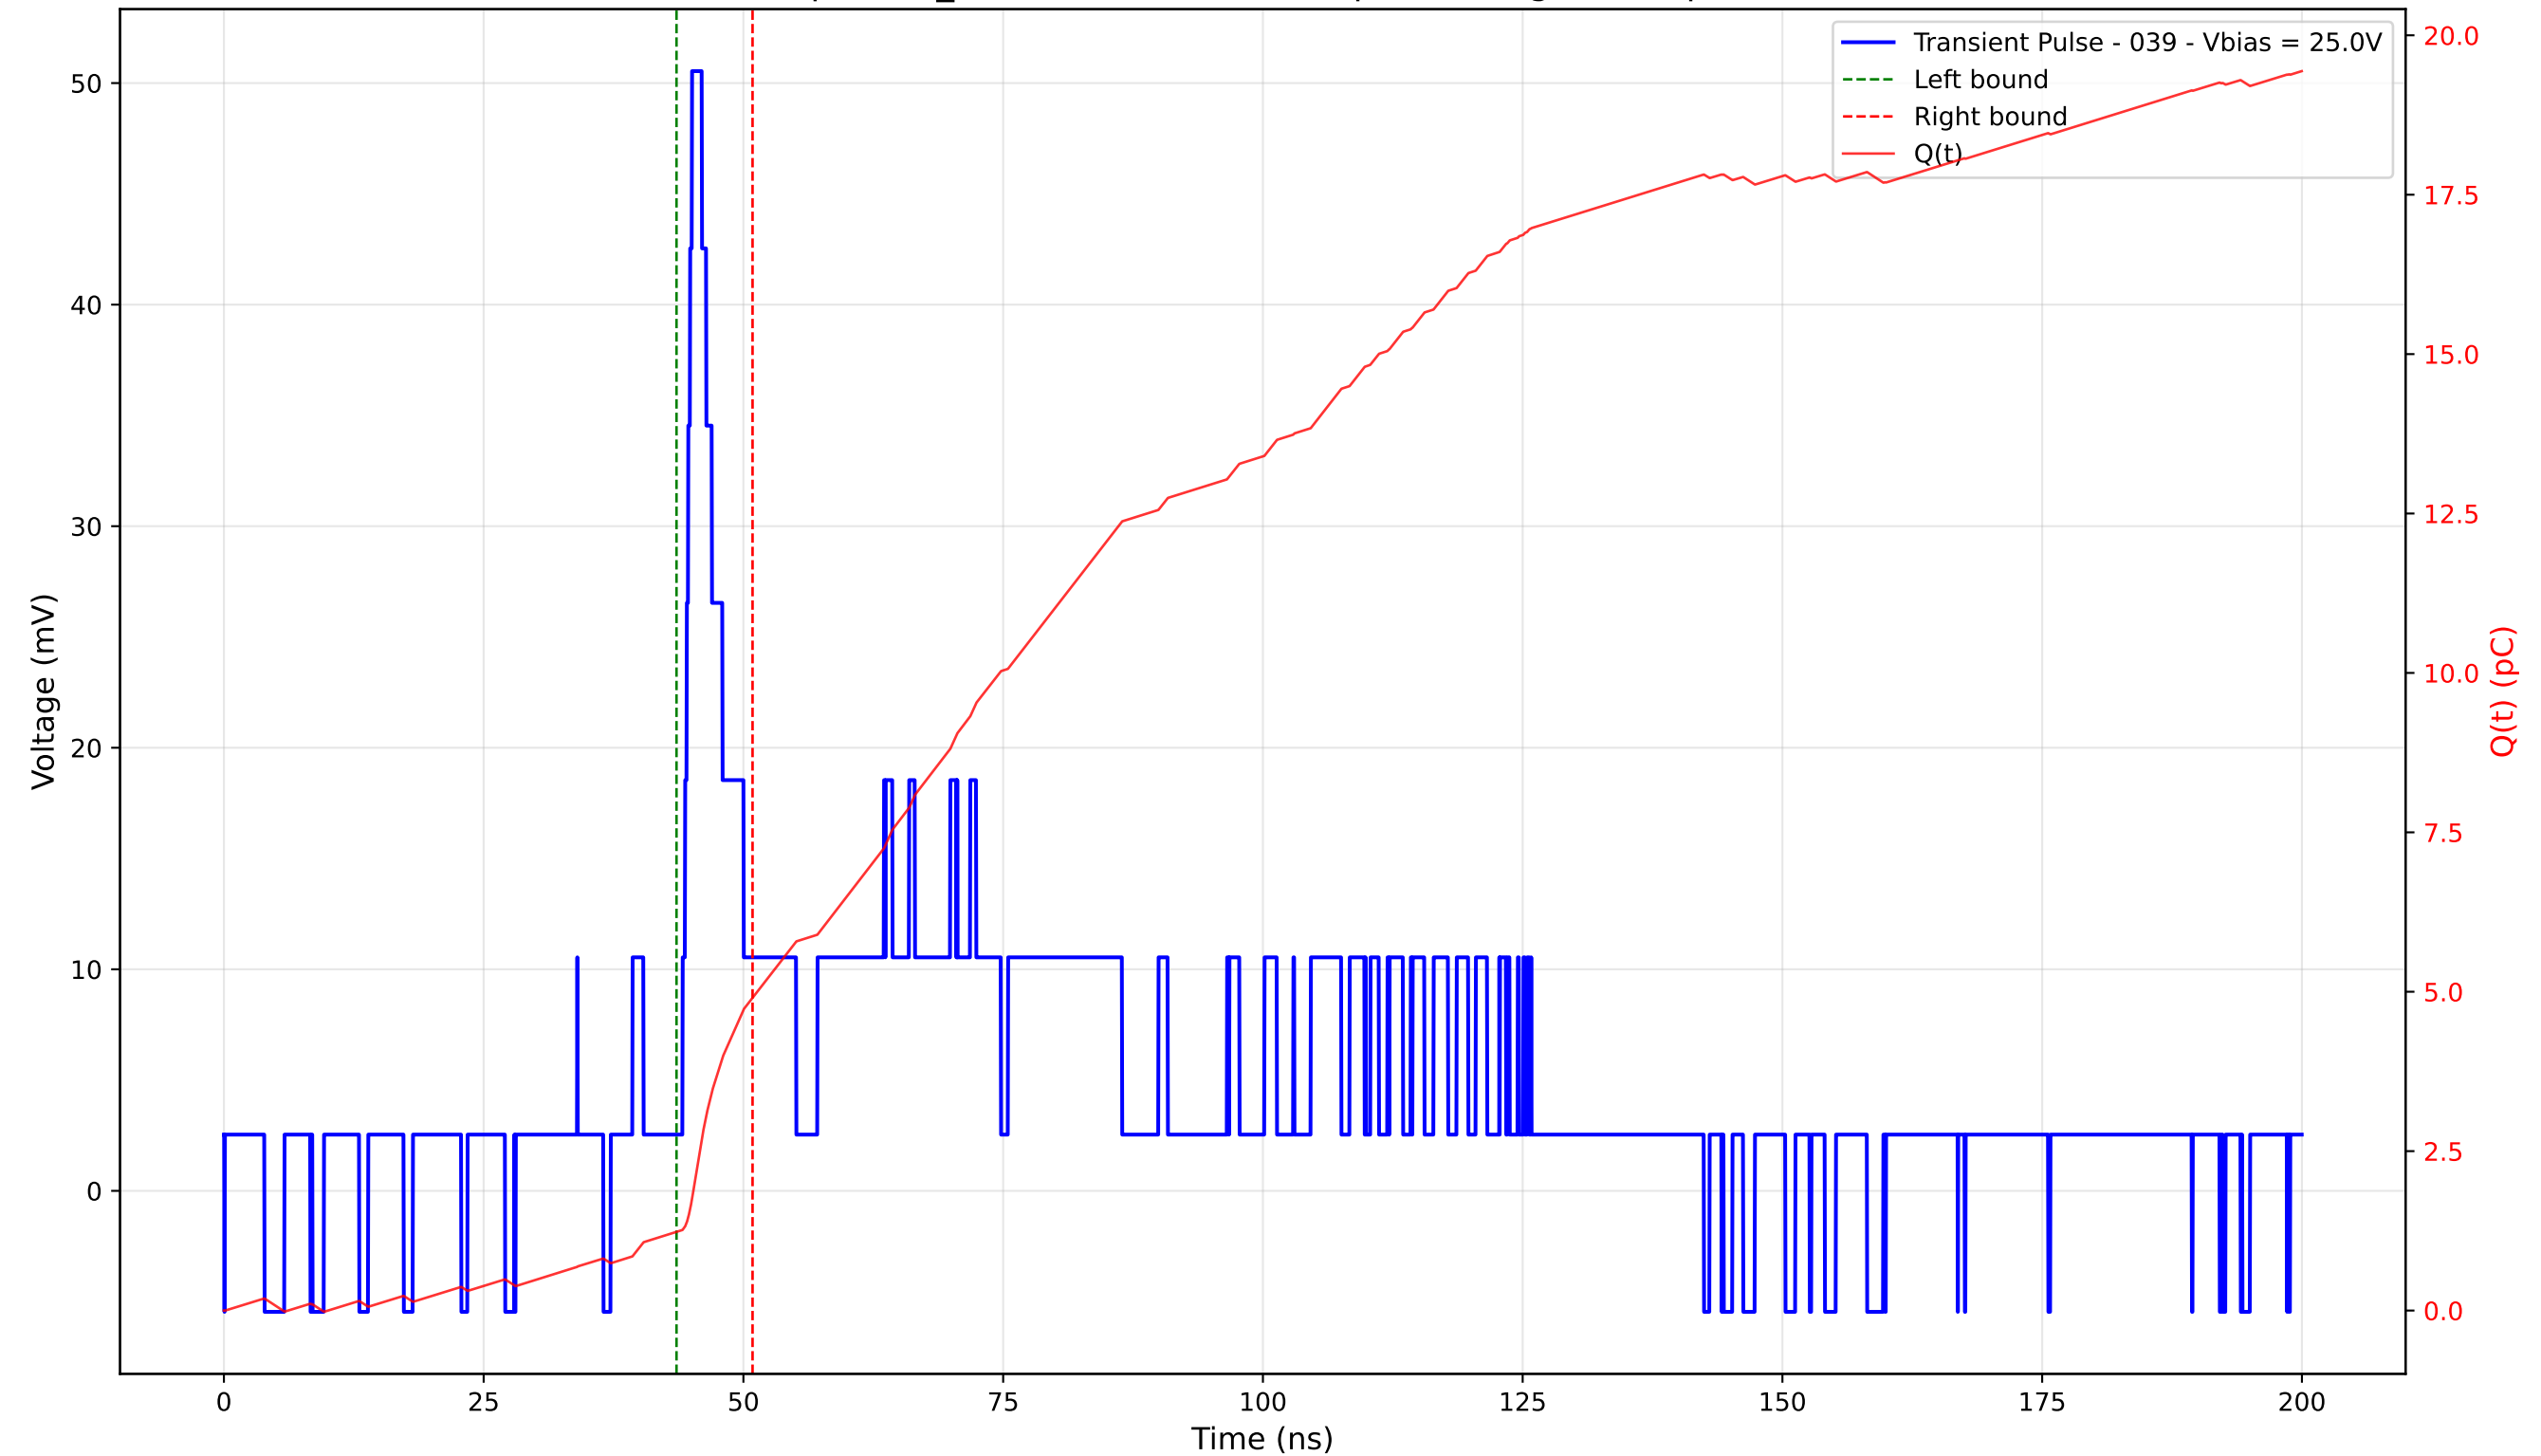


Transient Pulse - Sample: TD_4004 - Position: 400.0 μm - Charge: 2.53 pC - Rise Time: 0.92 ns

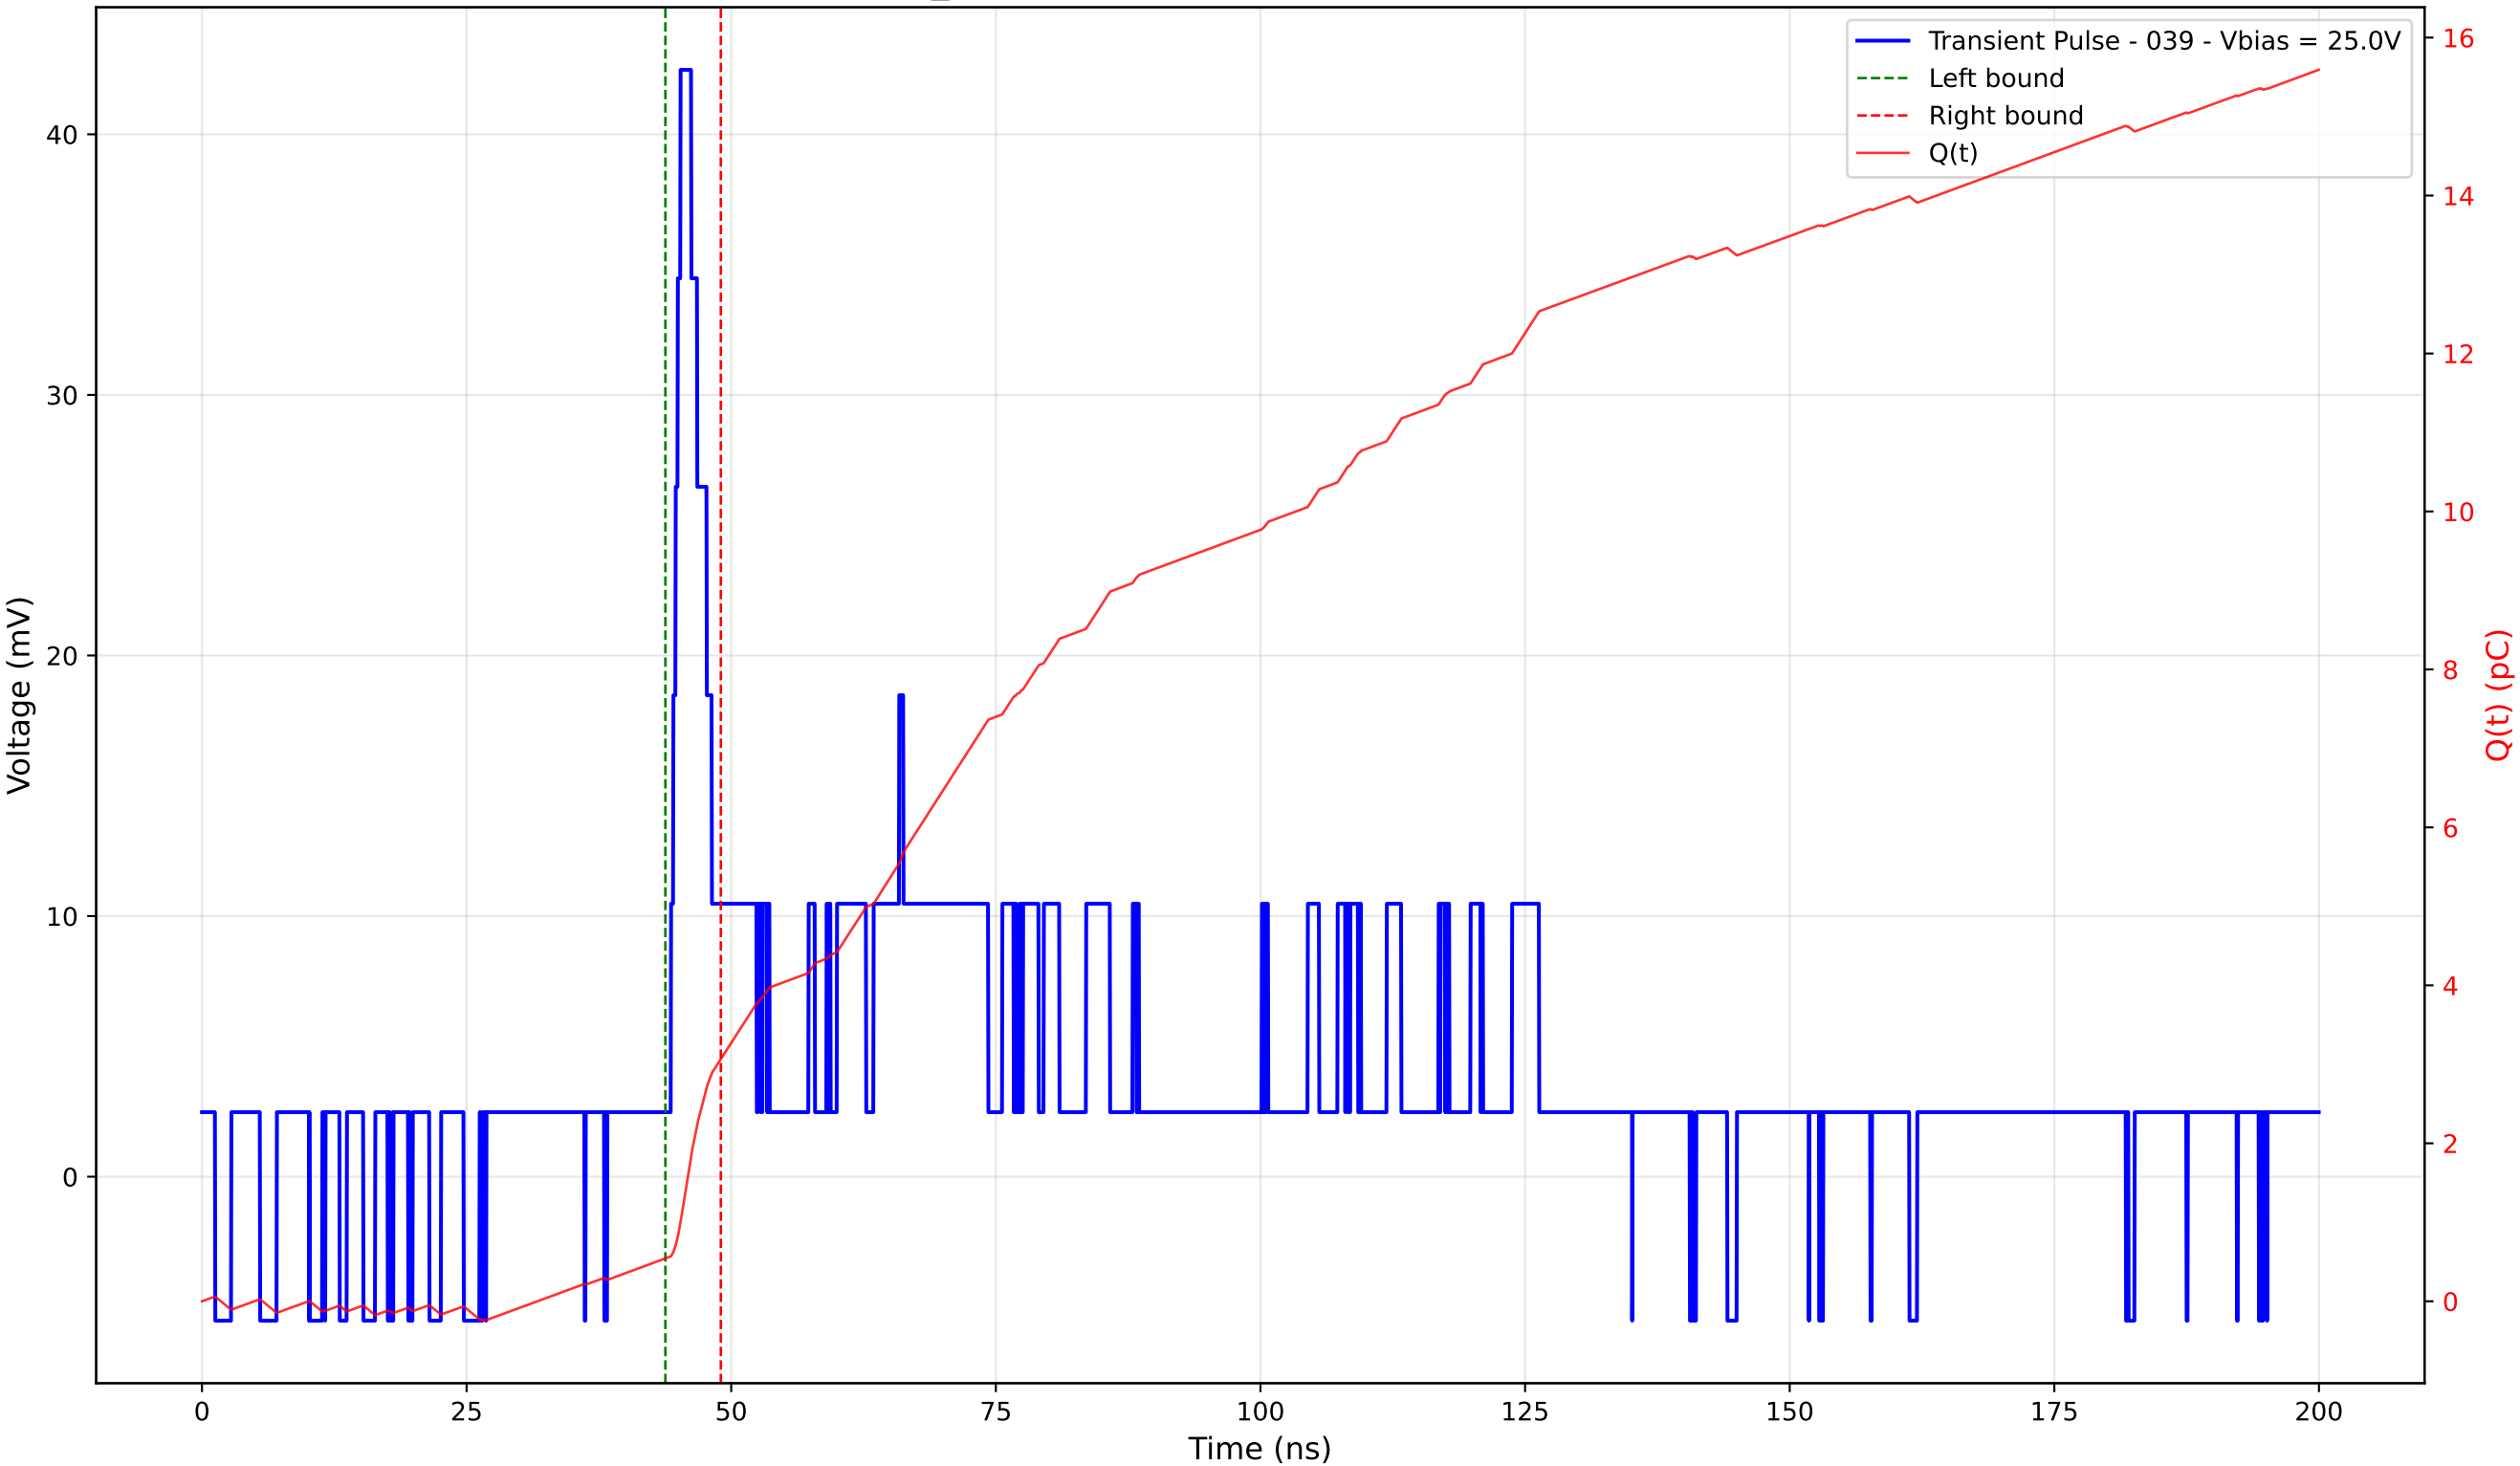


Transient Pulse - Sample: TD_4004 - Position: 405.0 μm - Charge: 1.91 pC - Rise Time: 0.88 ns

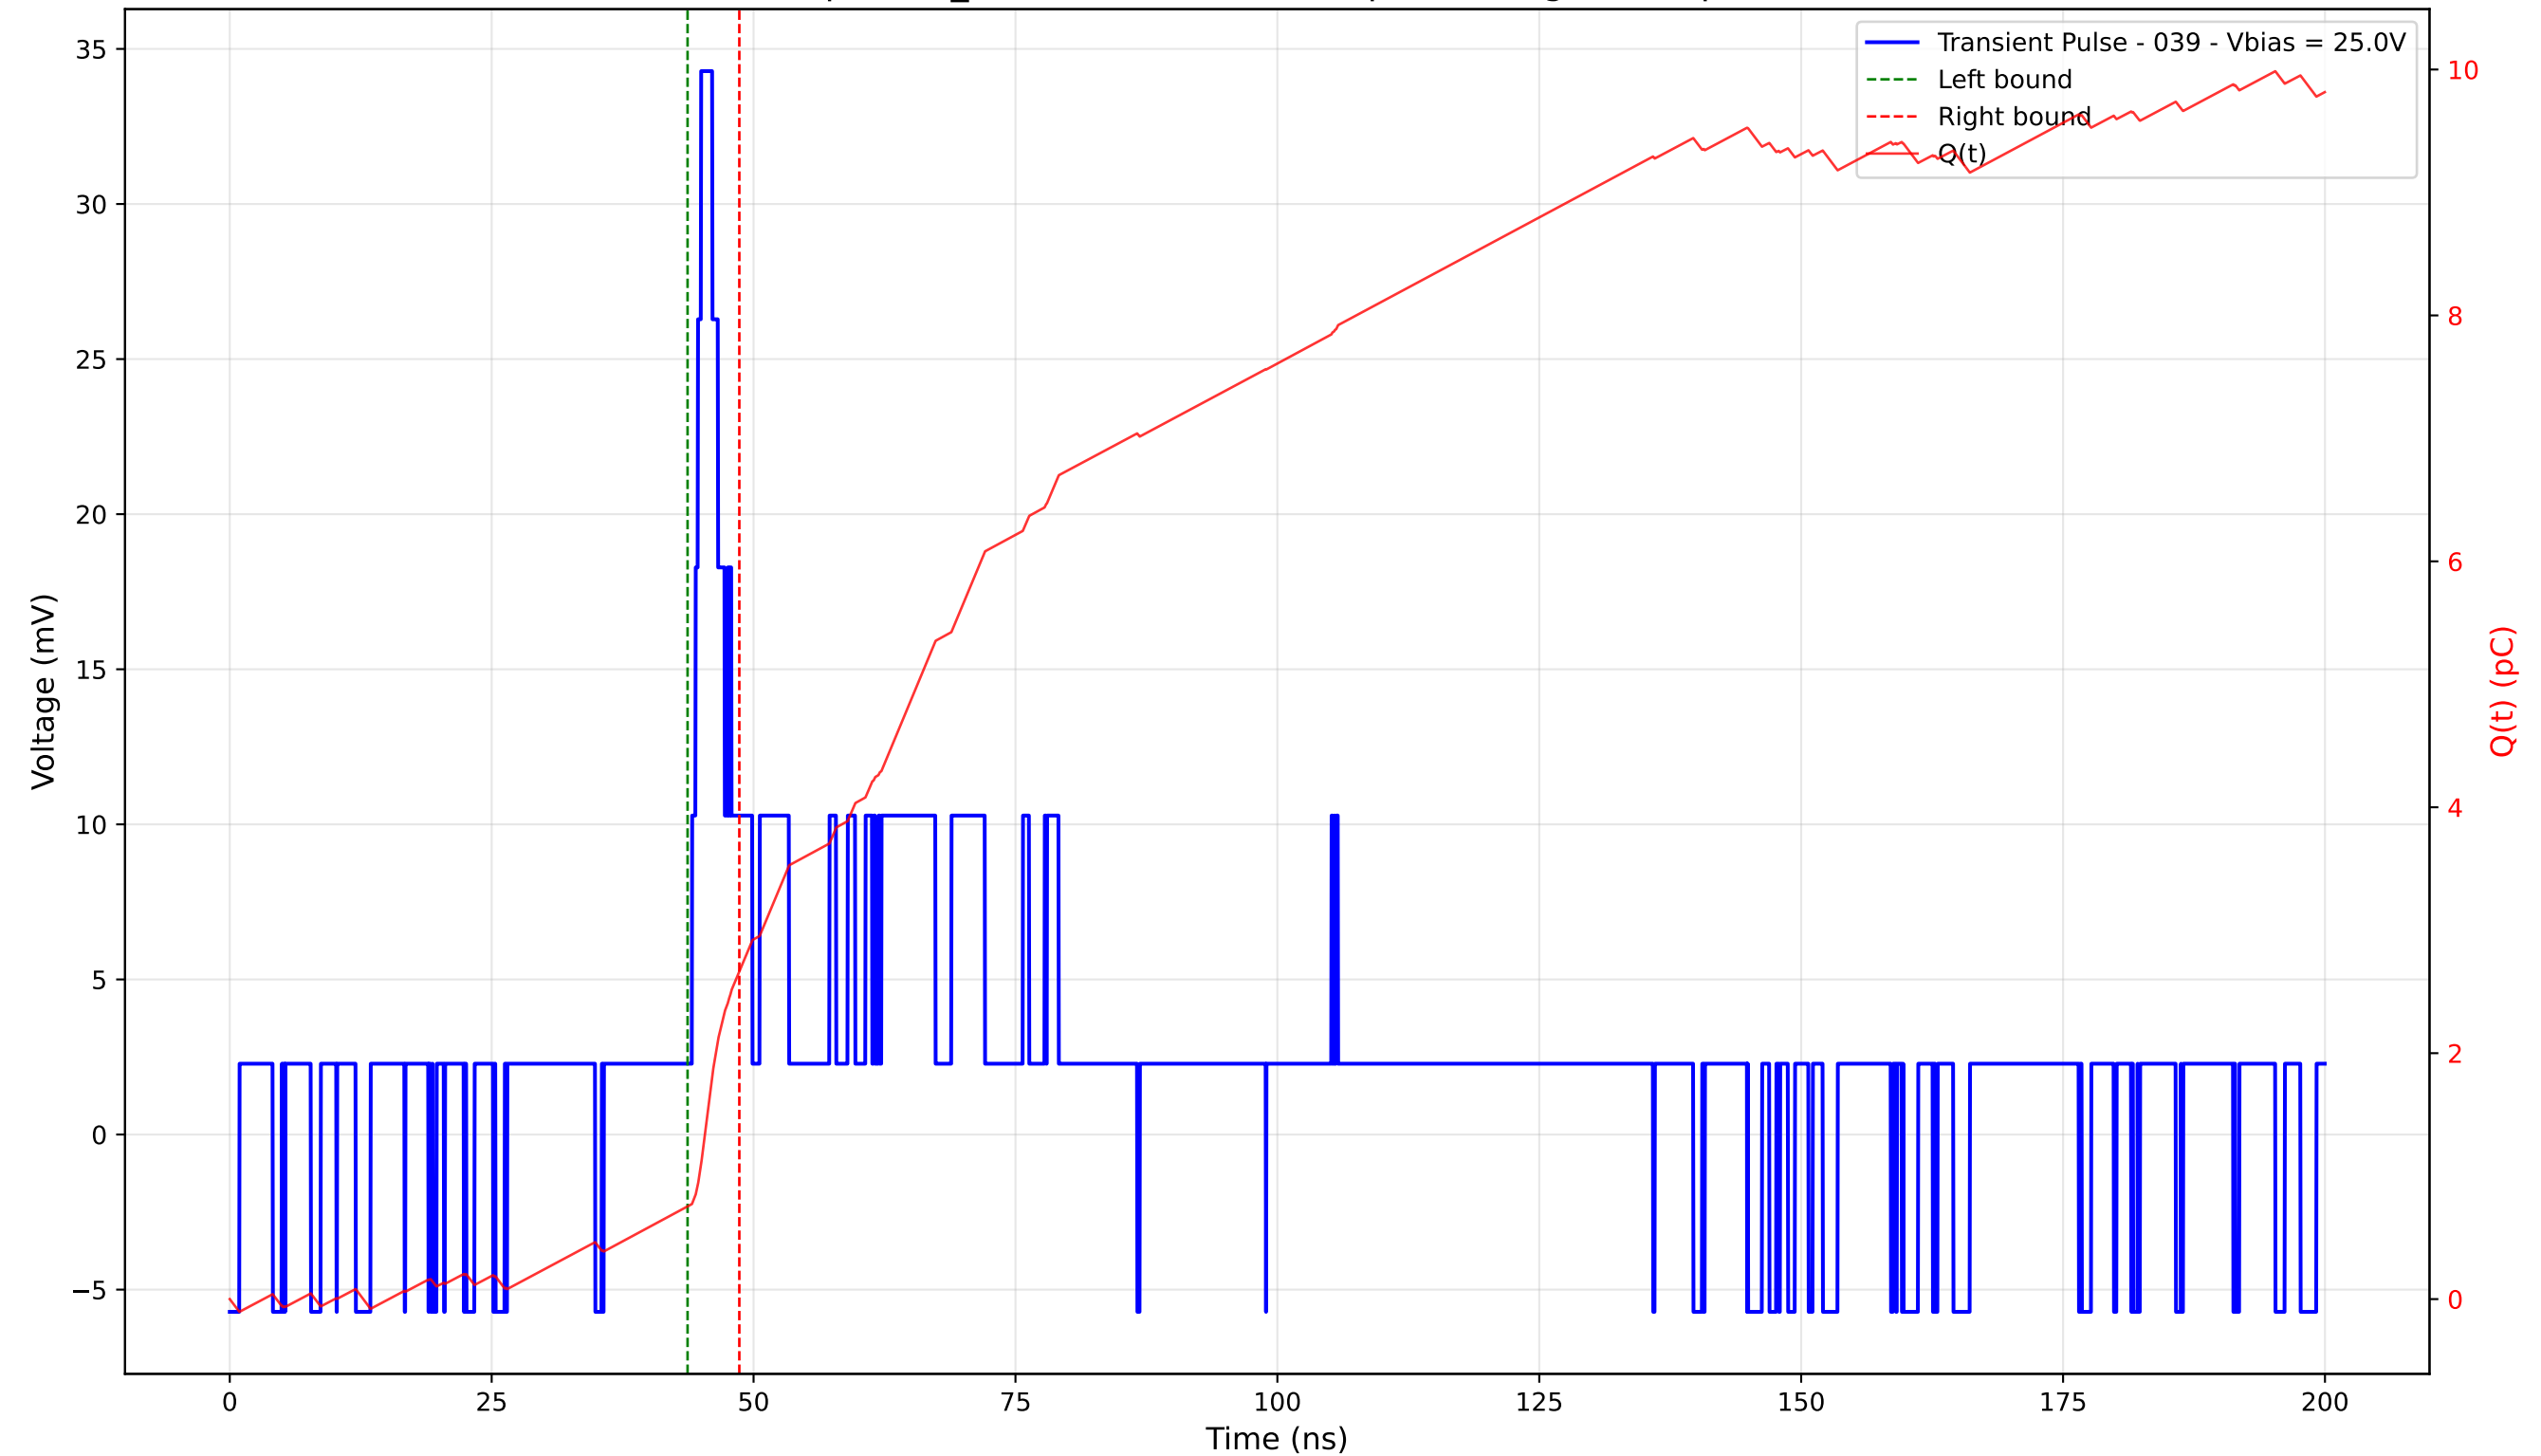


Transient Pulse - Sample: TD_4004 - Position: 410.0 μm - Charge: 1.69 pC - Rise Time: 0.56 ns

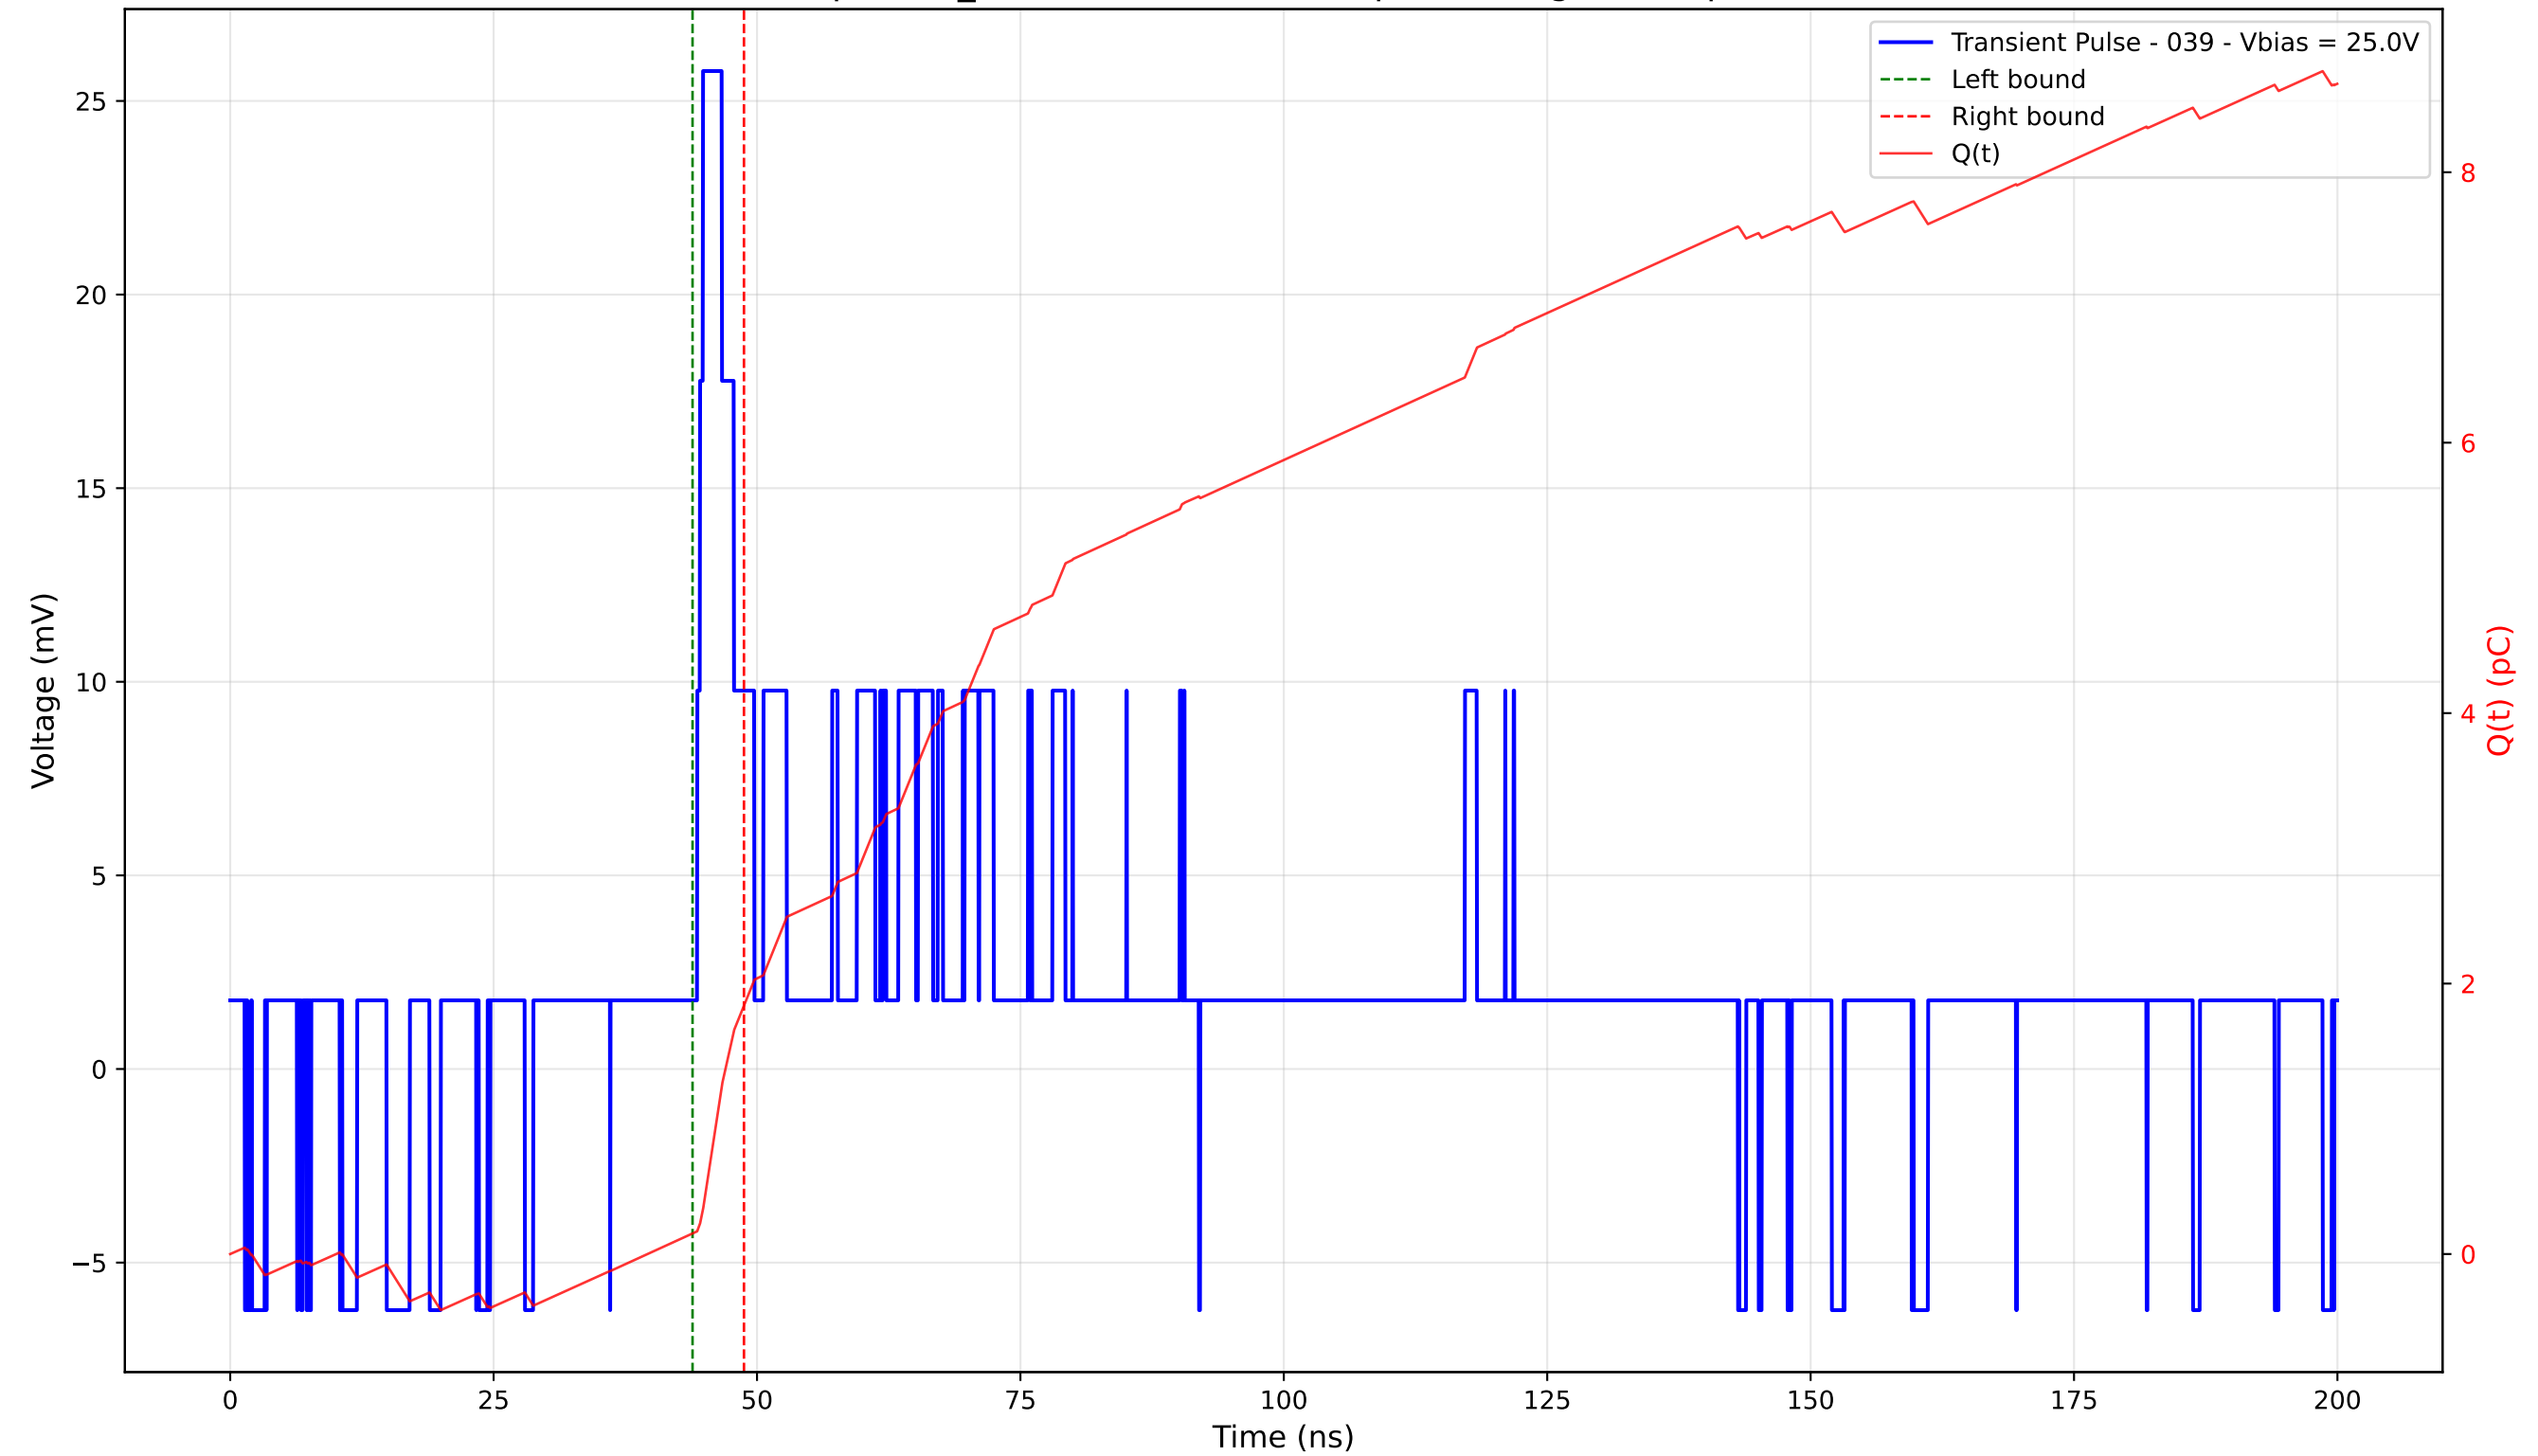


Transient Pulse - Sample: TD_4004 - Position: 415.0 μm - Charge: 1.56 pC - Rise Time: 0.74 ns

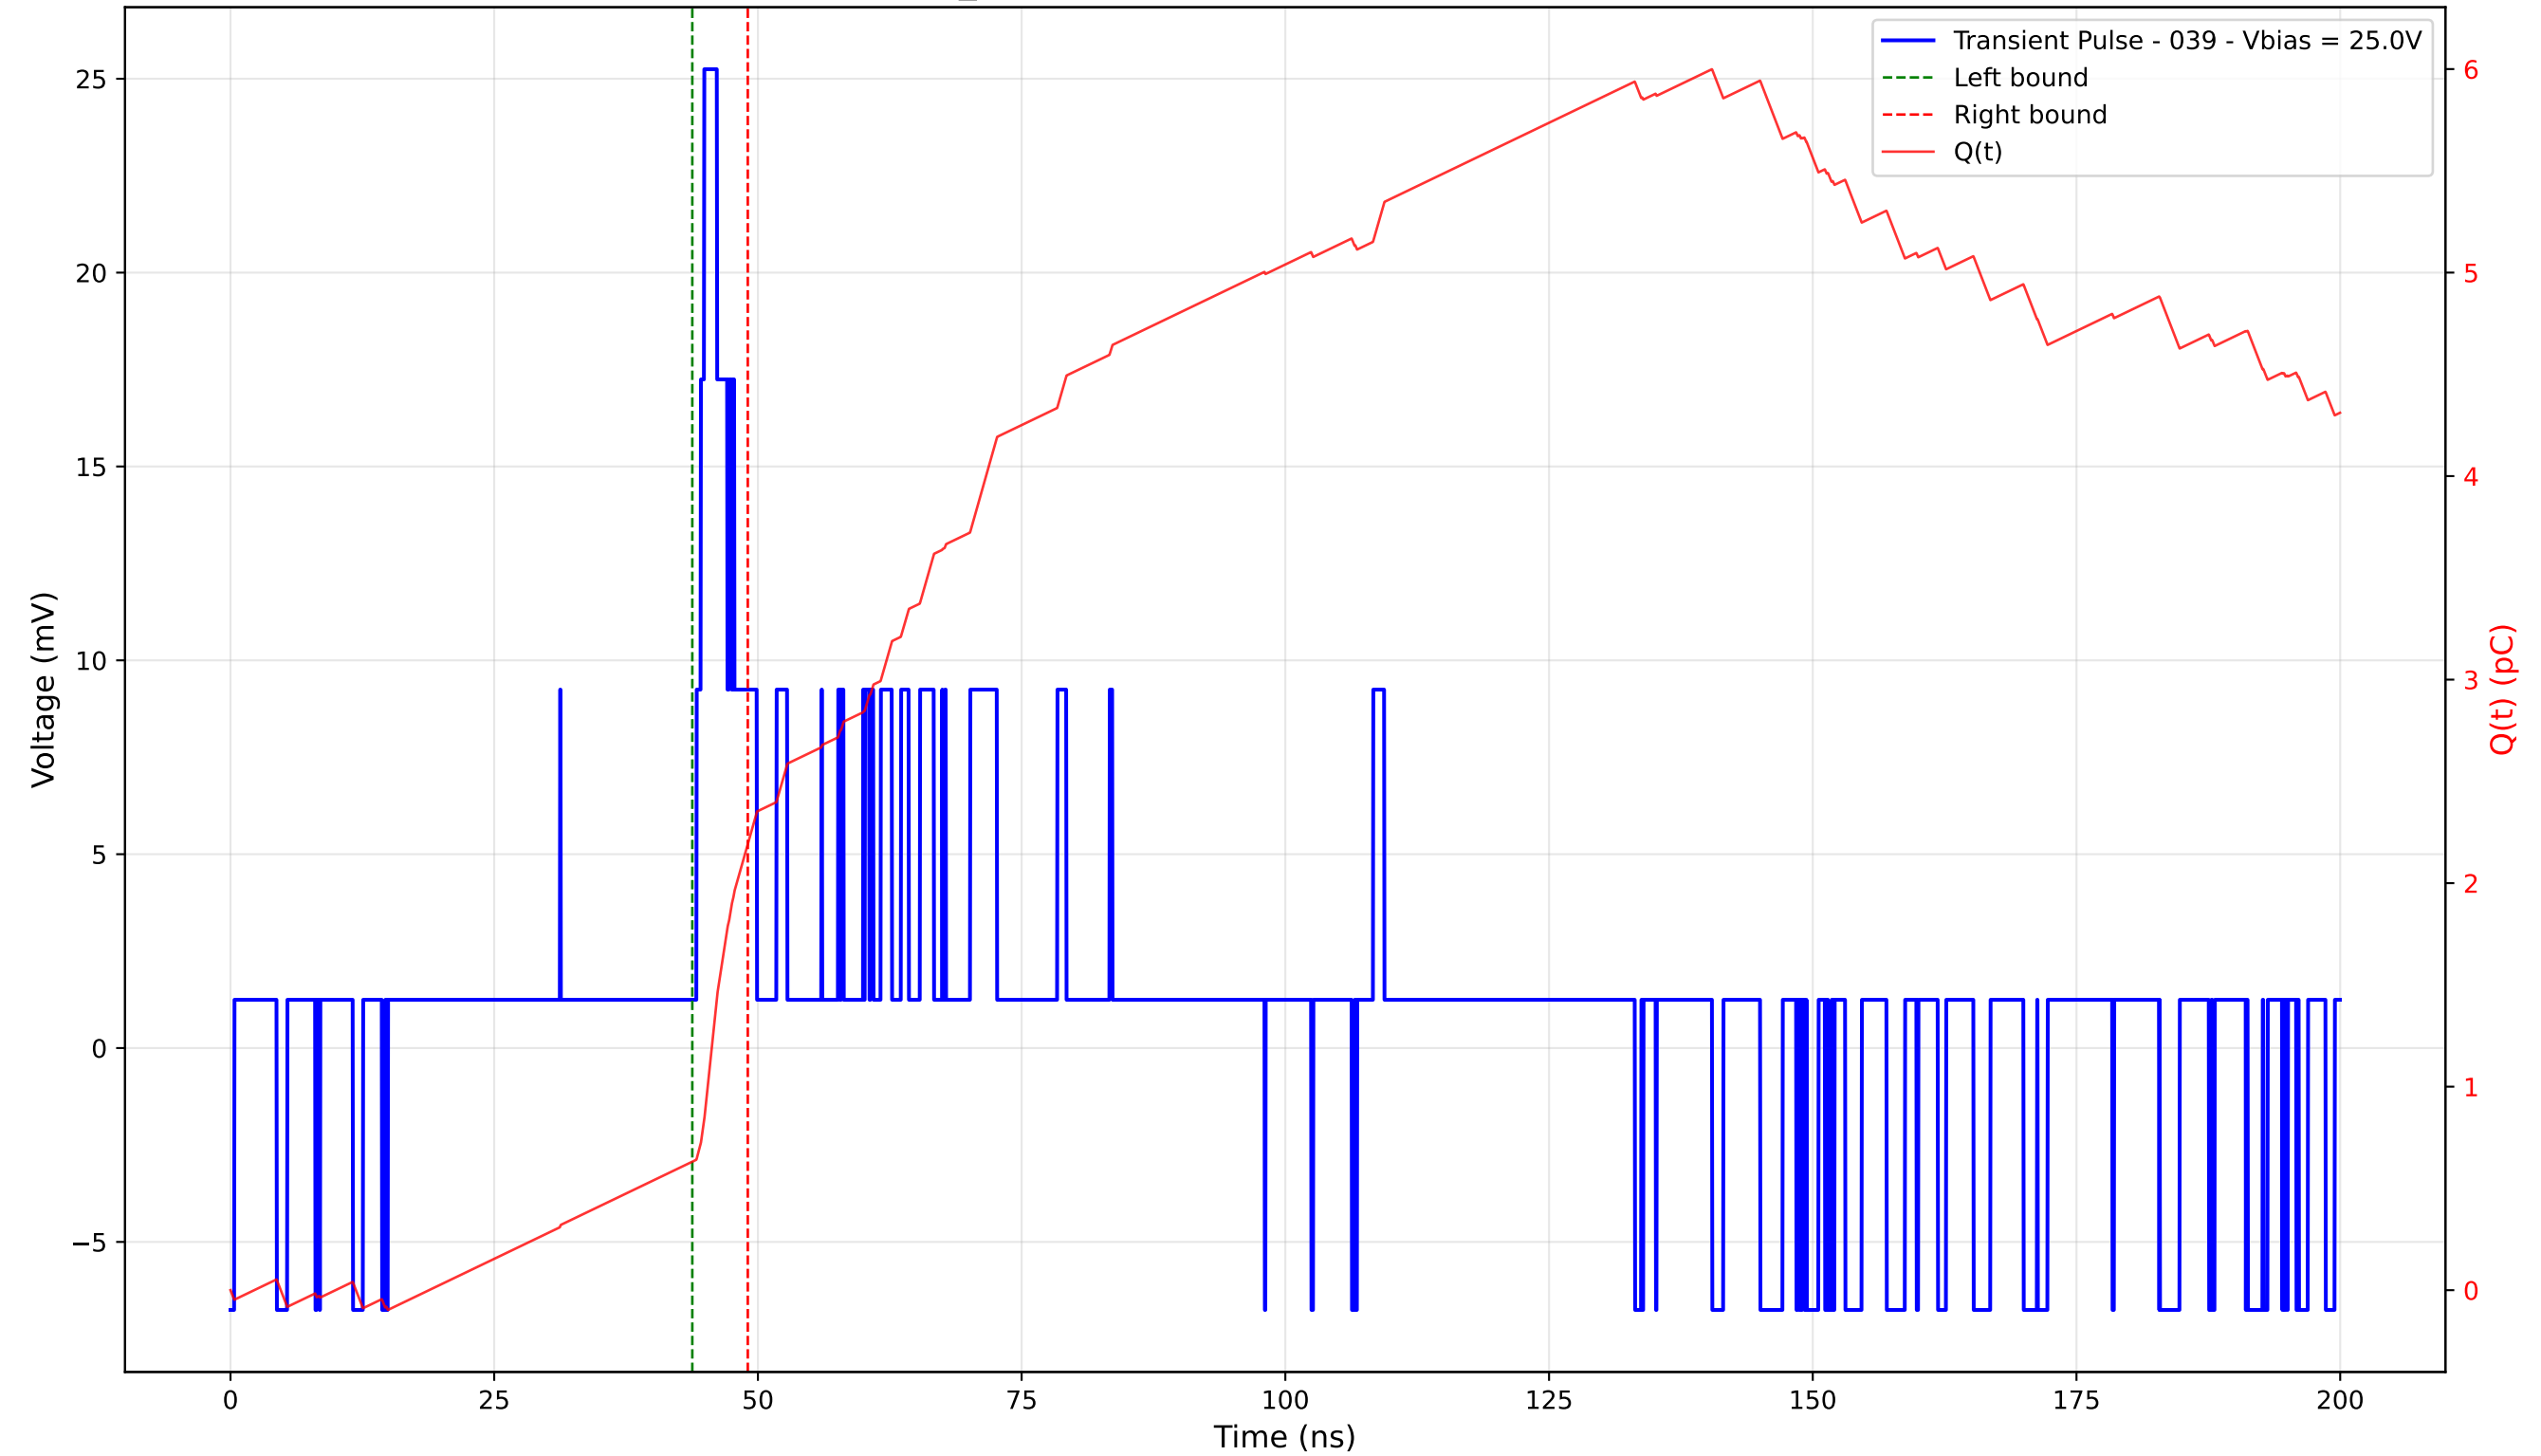


Transient Pulse - Sample: TD_4004 - Position: 420.0 μm - Charge: 4.58 pC - Rise Time: 0.00 ns (N/A)

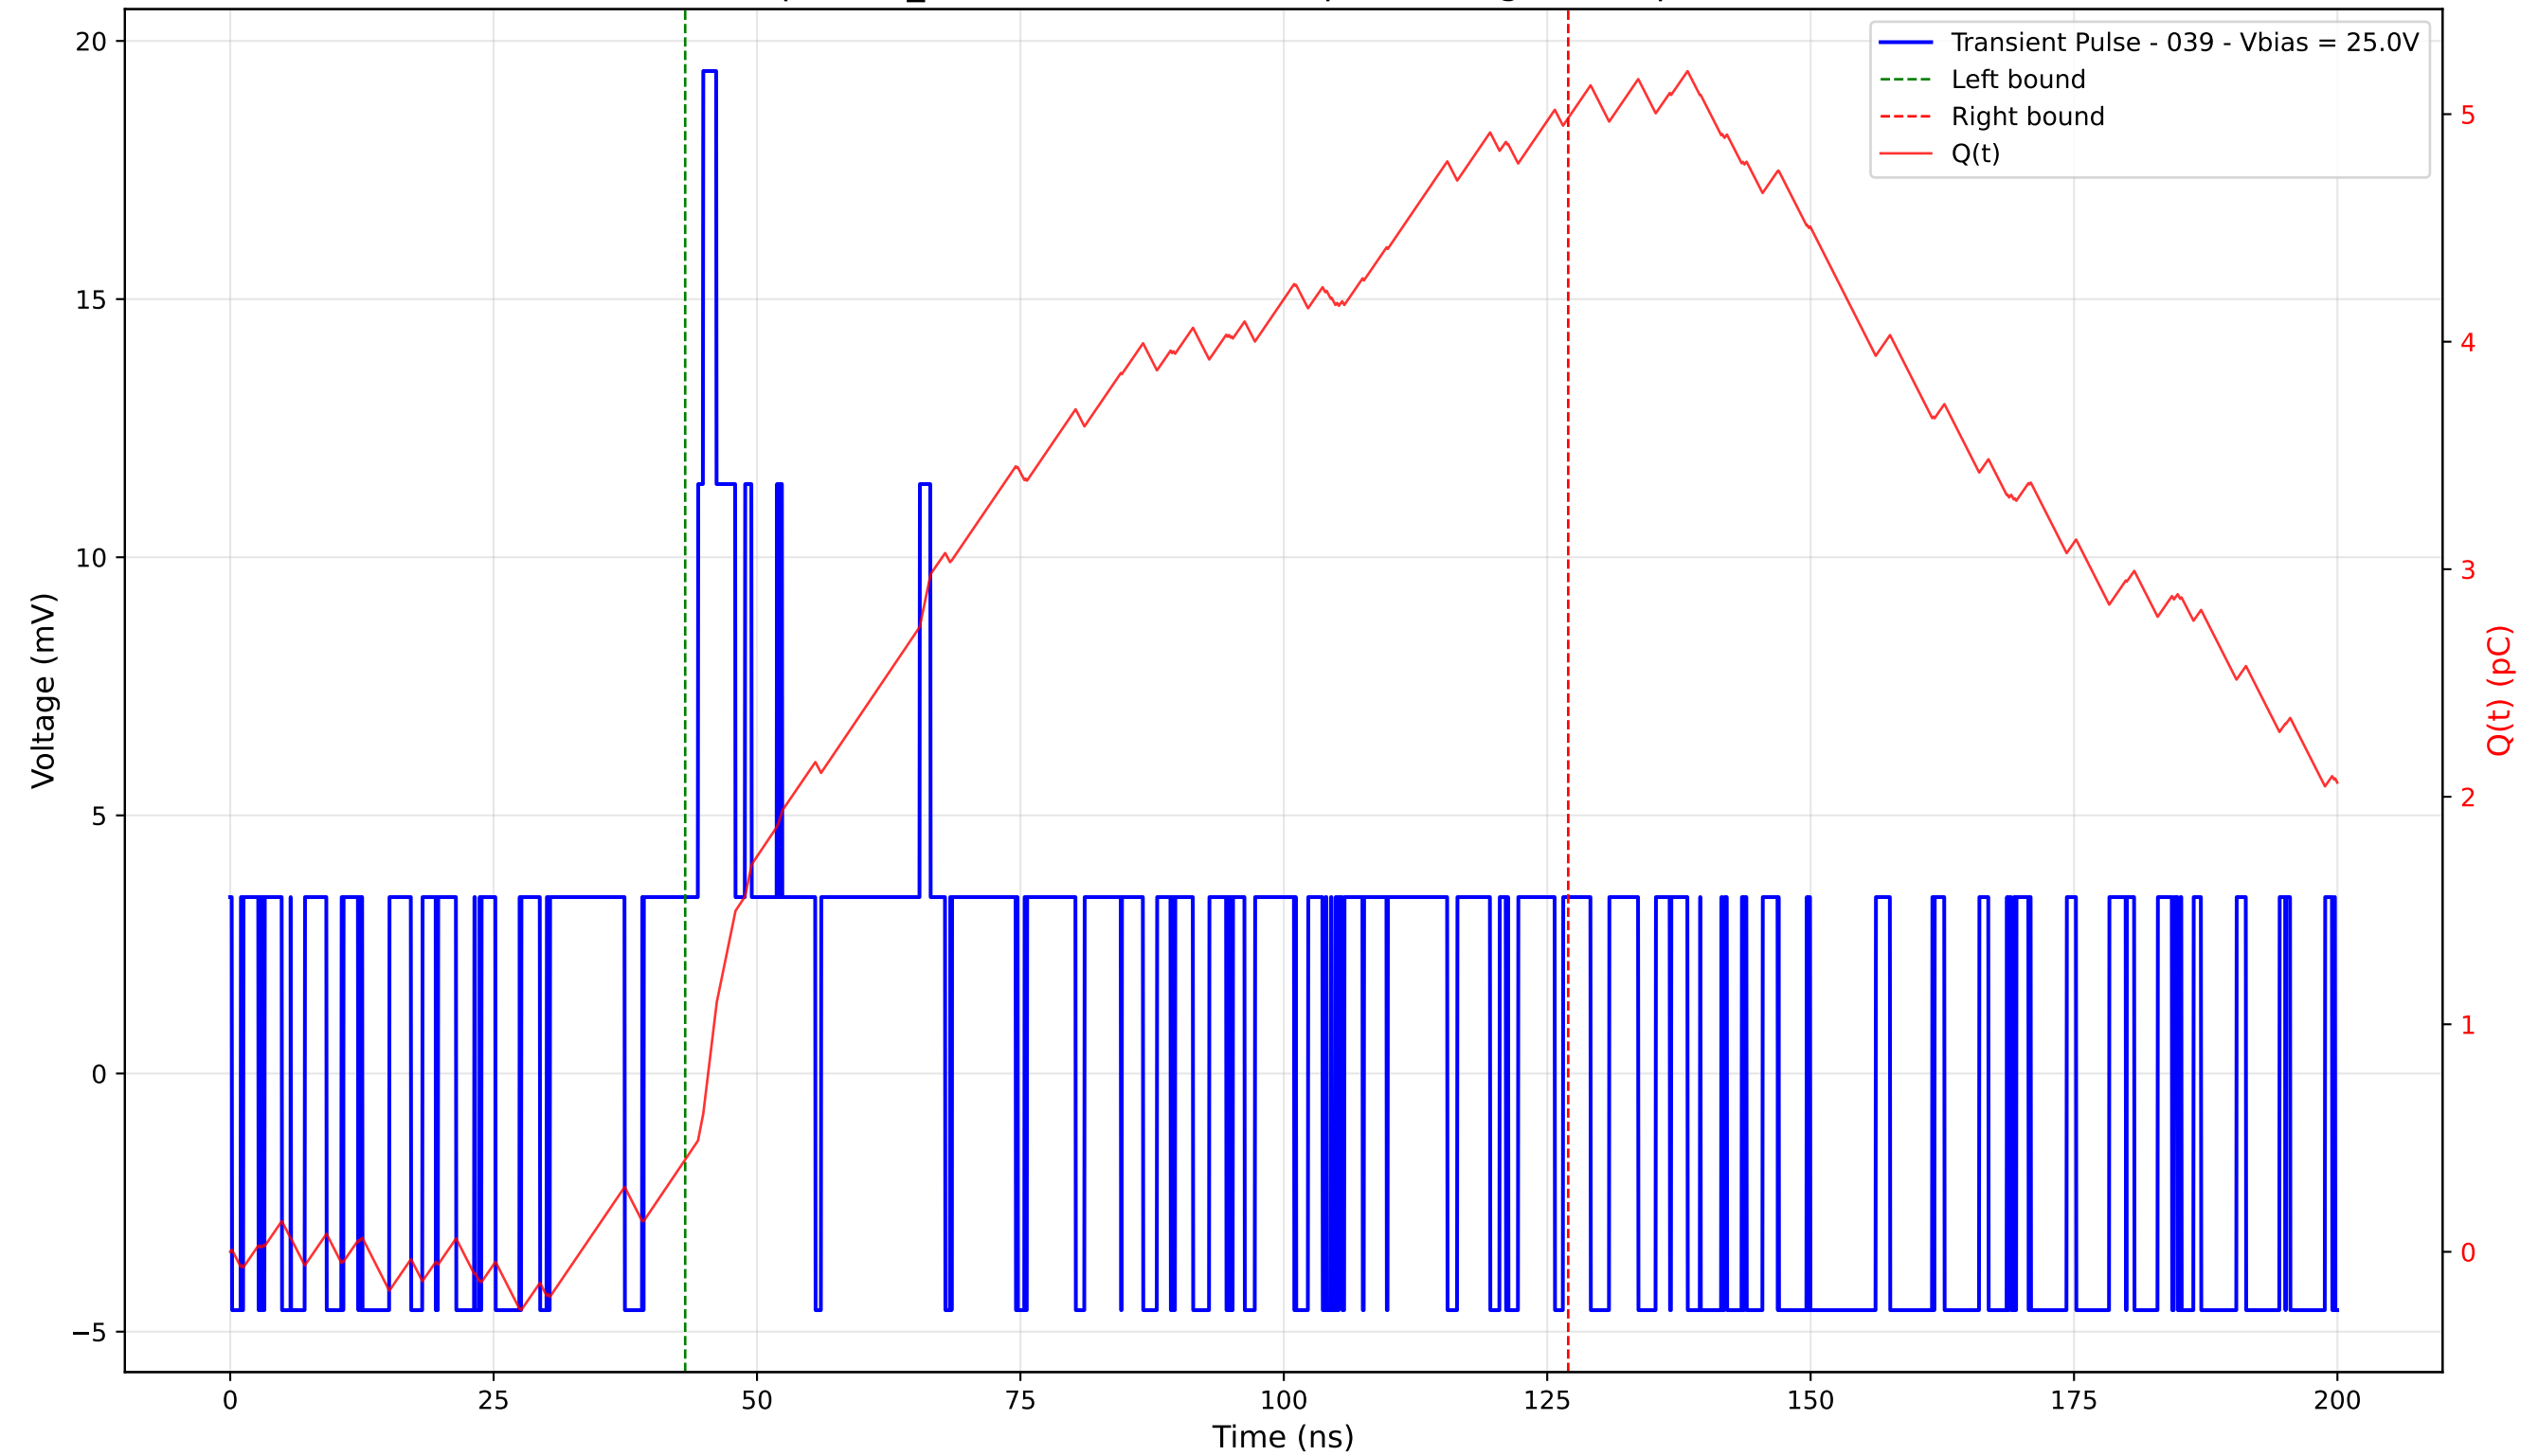

Transient Pulse - Sample: TD_4004 - Position: 425.0 μm - Charge: 9.13 pC - Rise Time: 0.00 ns (N/A)

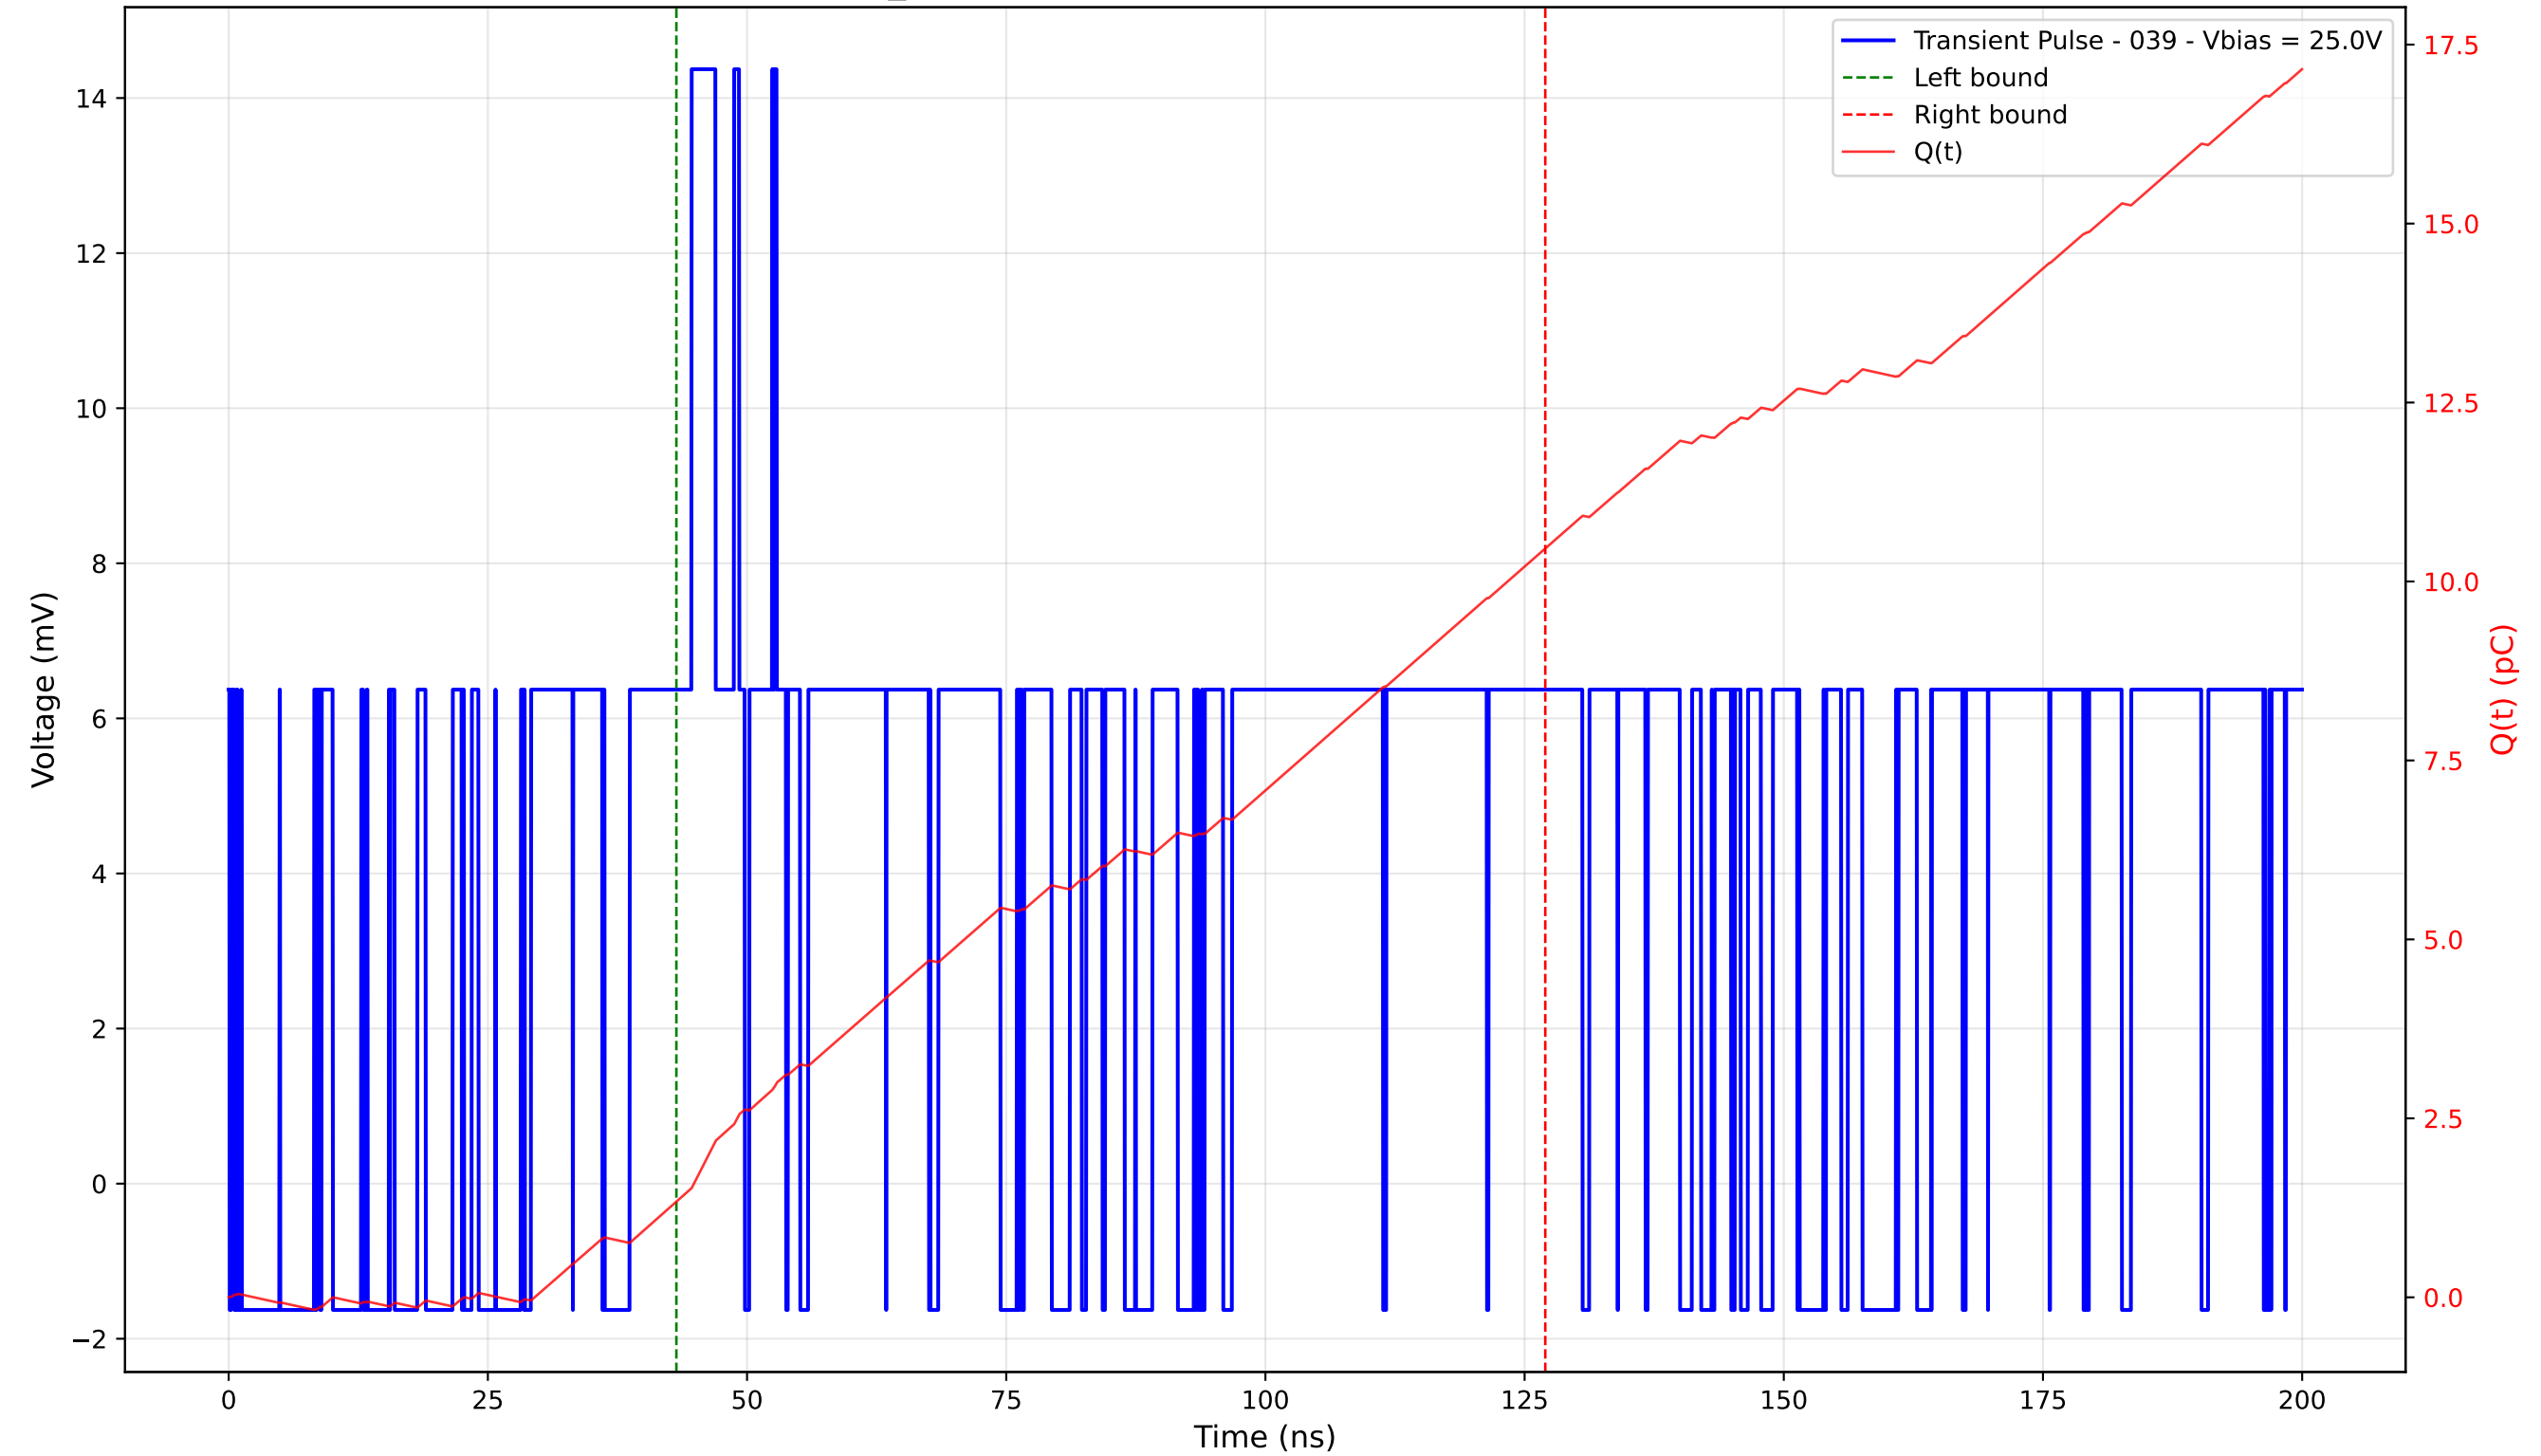

Transient Pulse - Sample: TD_4004 - Position: 430.0 μm - Charge: 3.82 pC - Rise Time: 0.00 ns (N/A)

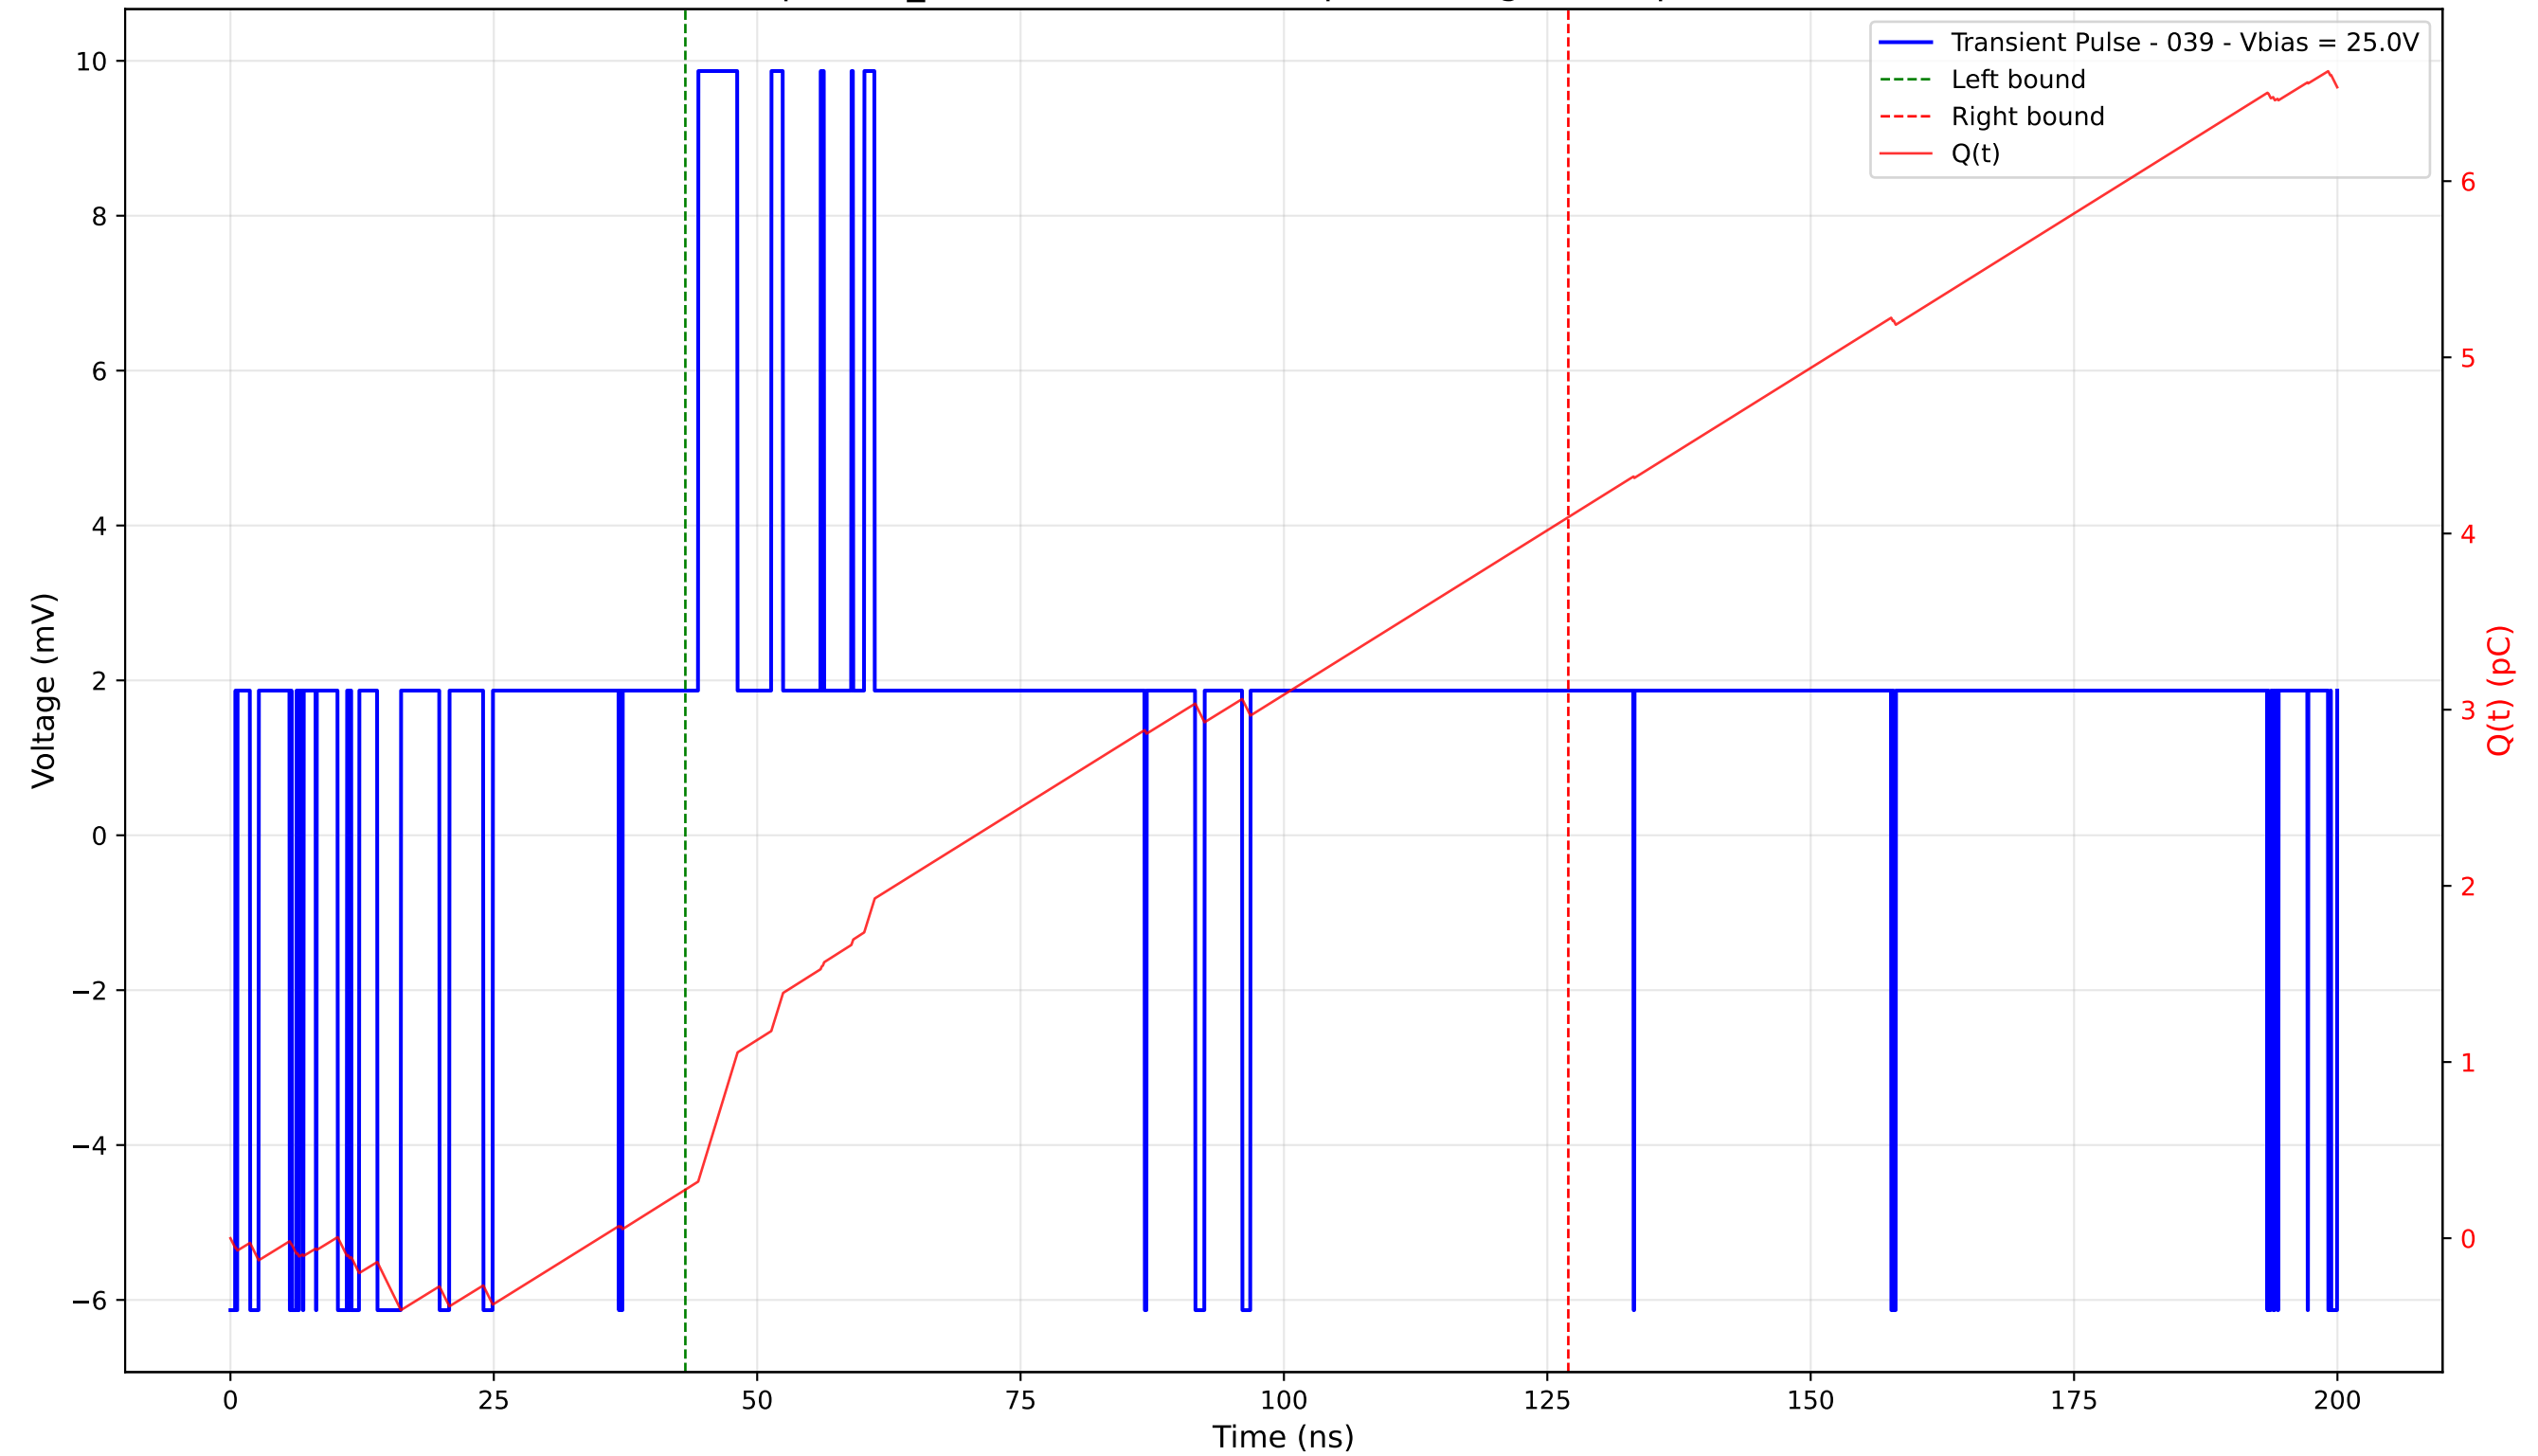

Transient Pulse - Sample: TD_4004 - Position: 435.0 μm - Charge: 2.24 pC - Rise Time: 0.00 ns (N/A)

