



TCT Run Run013 Summary

Parameter	Value
Run	Run013
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	230.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\230V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A


Collected Charge

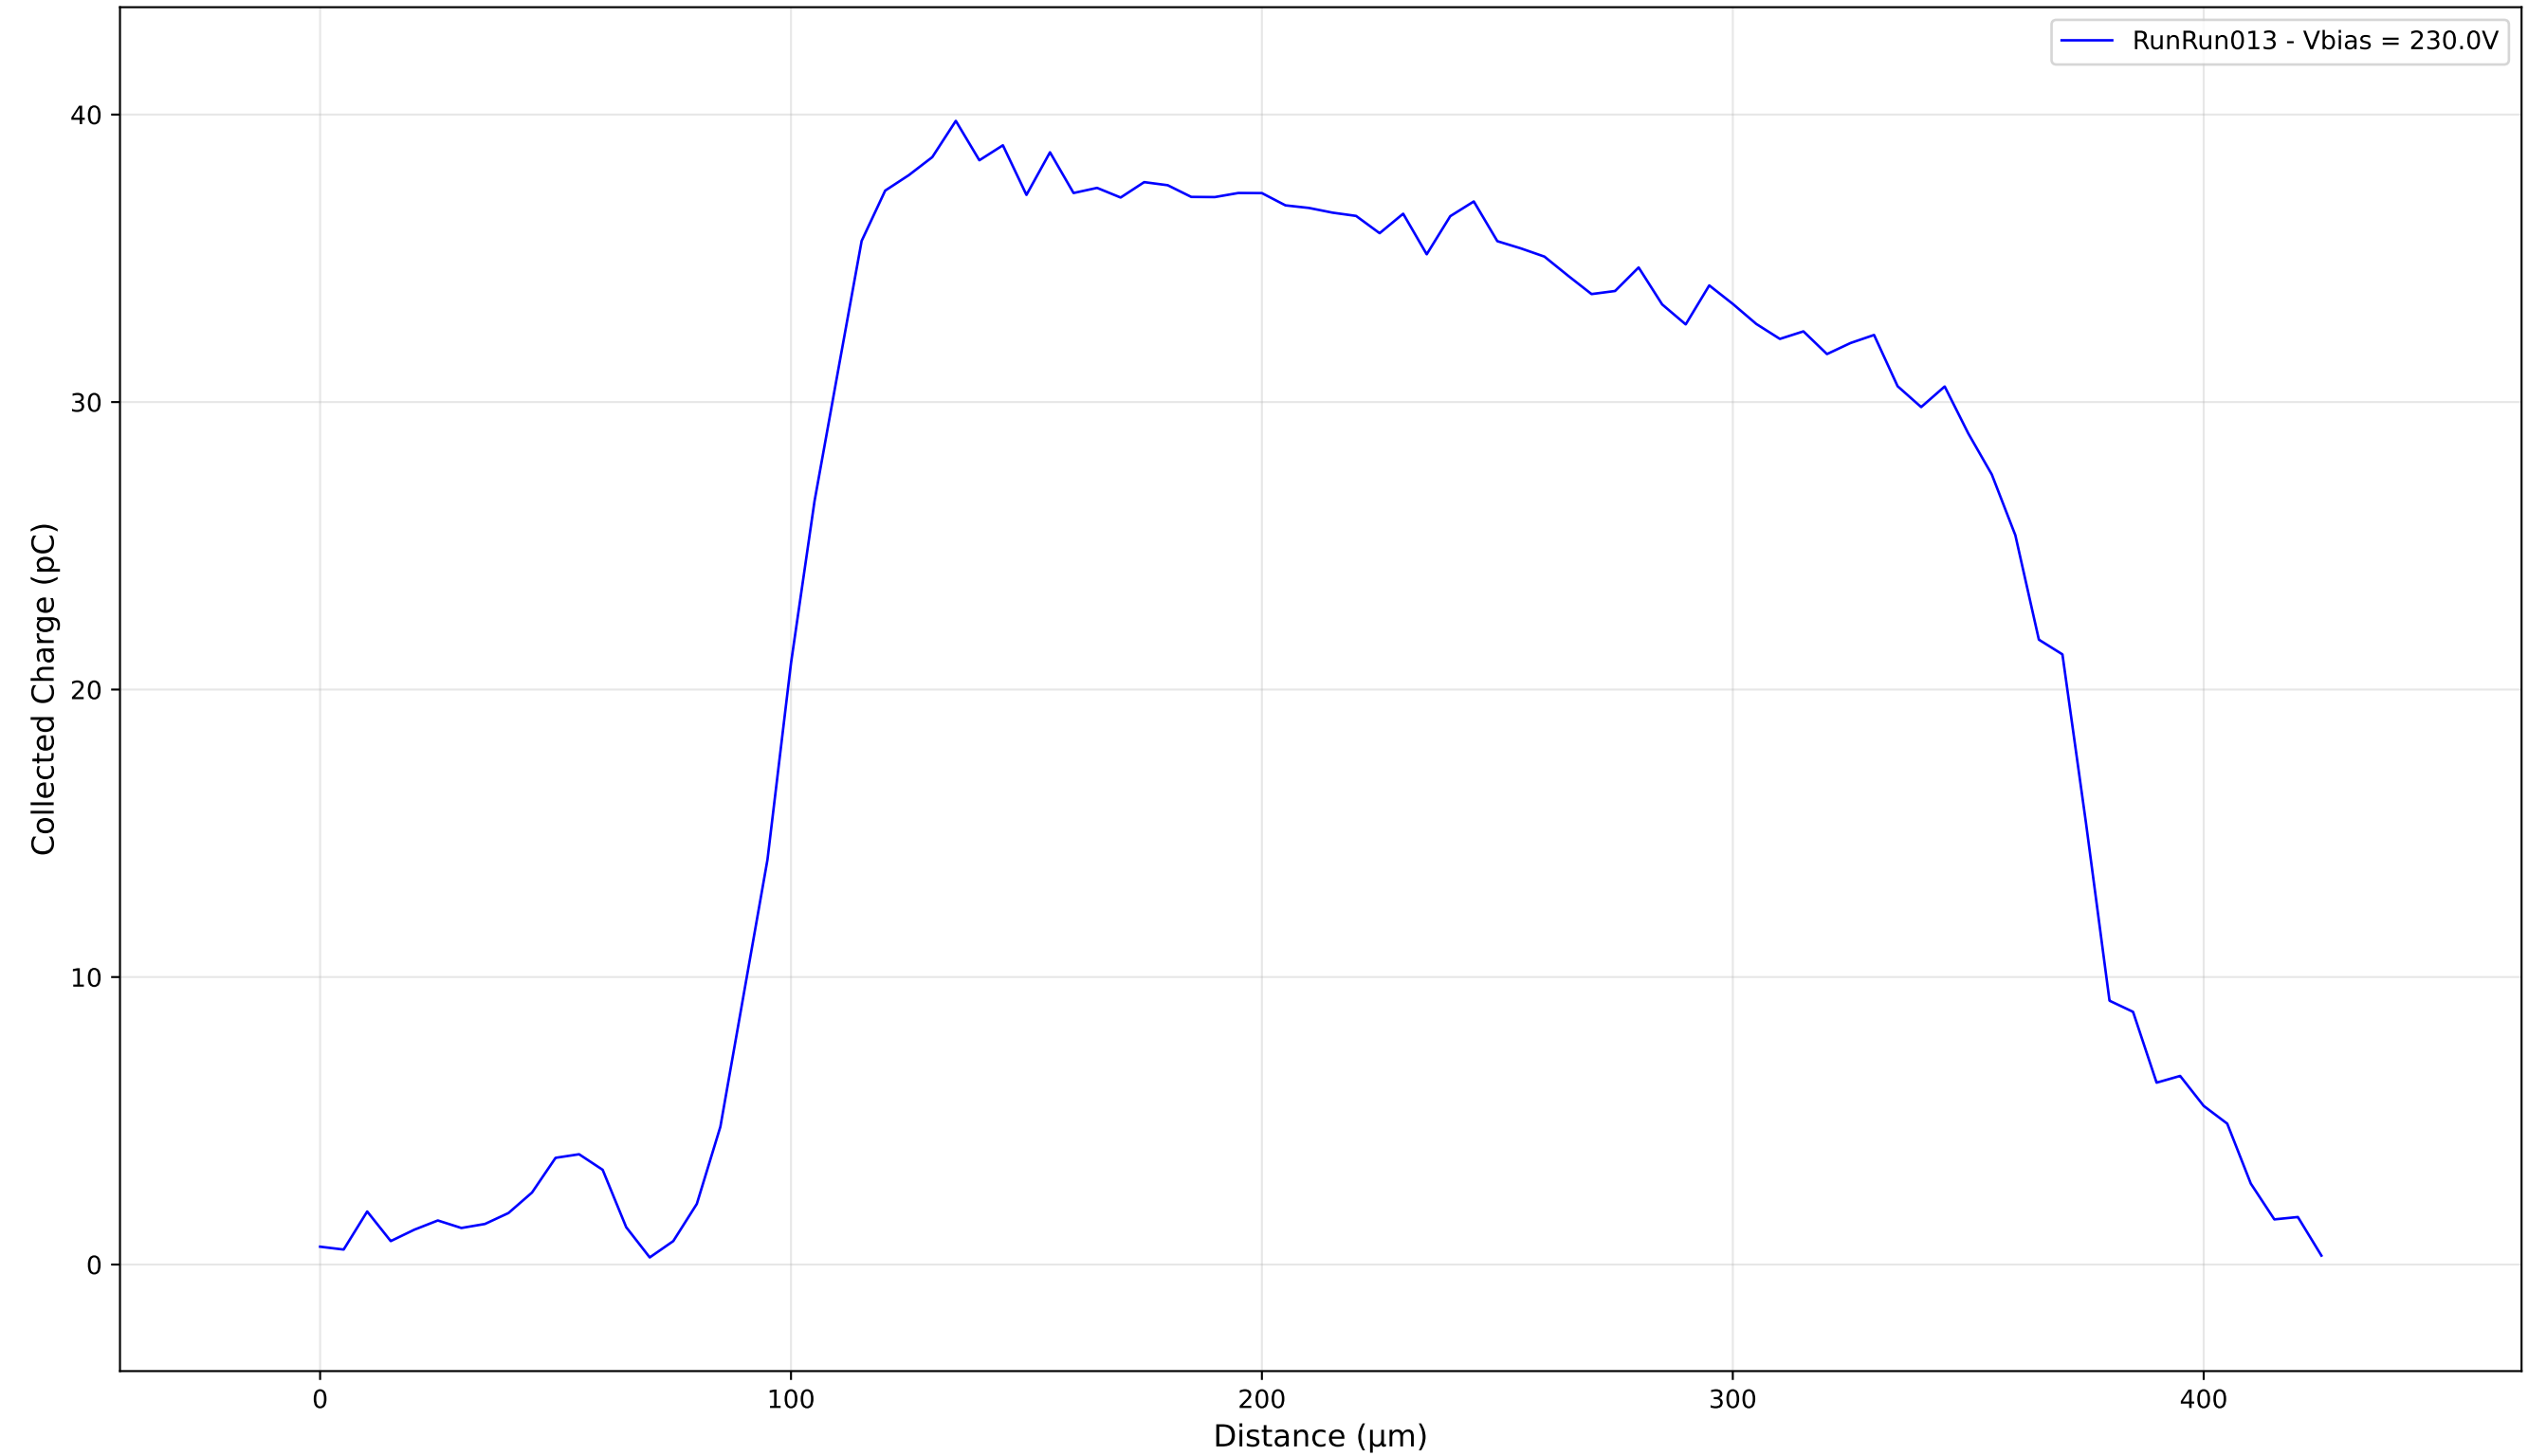


Collected Charge

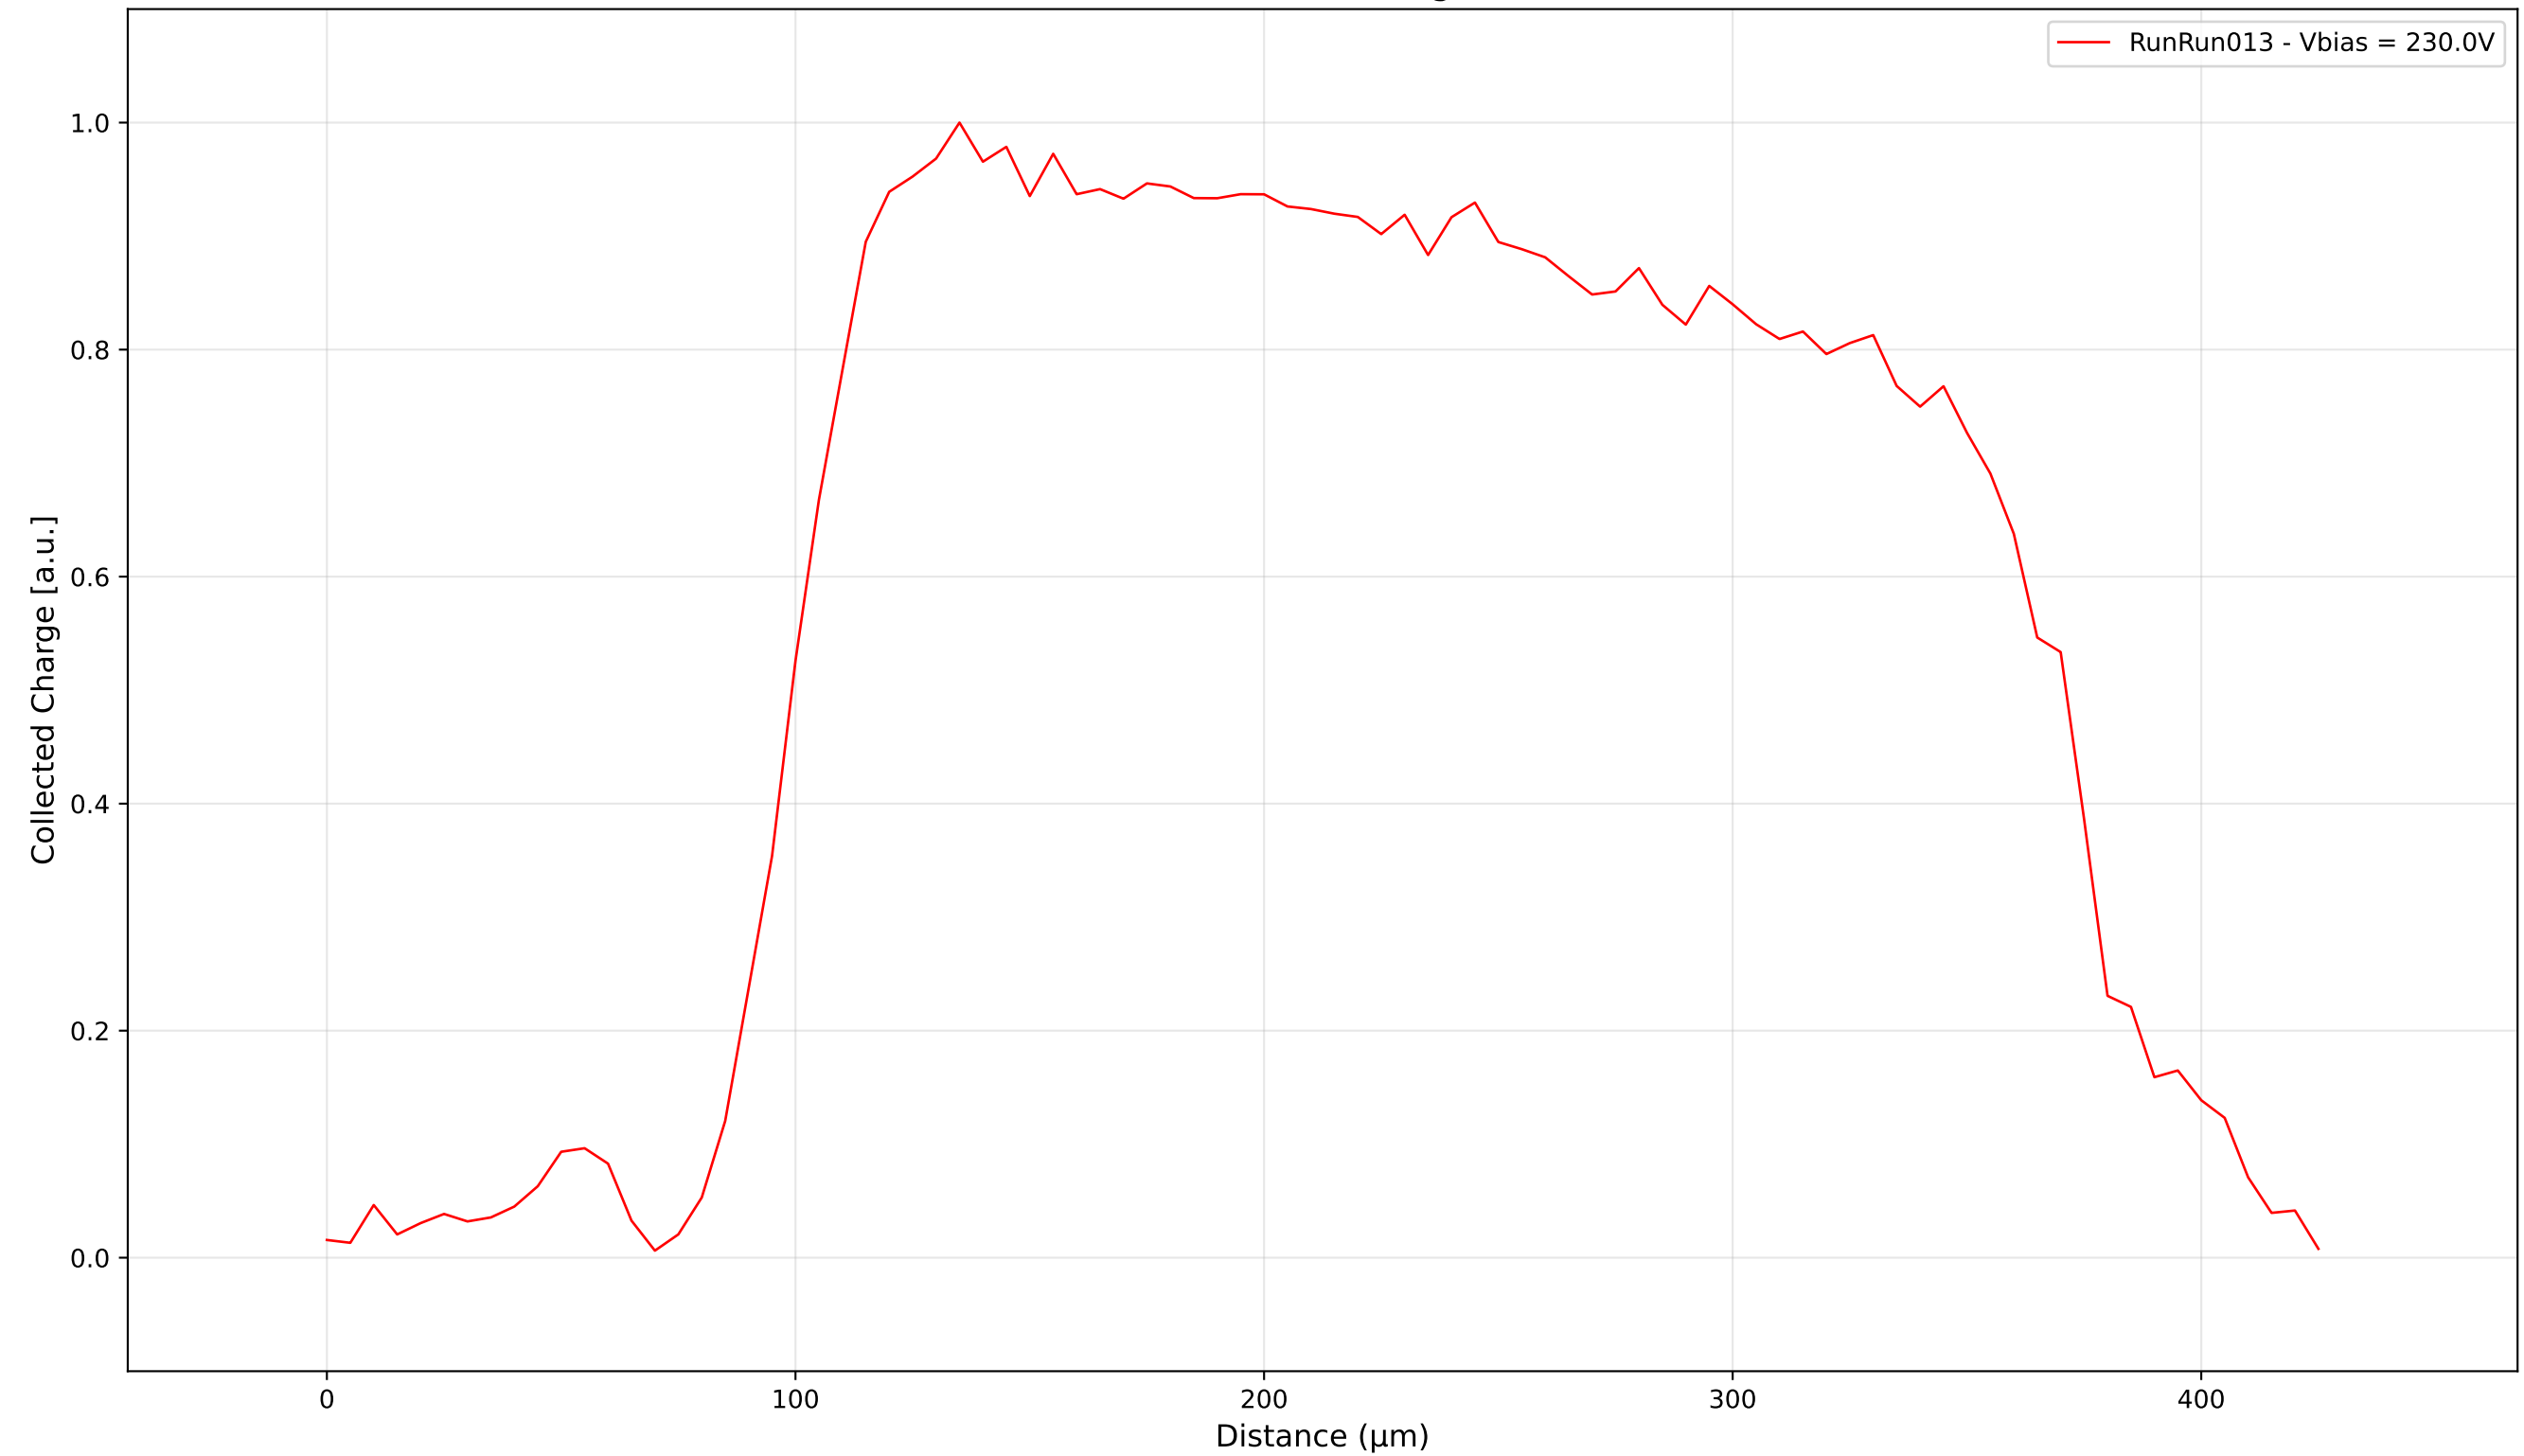


Rise Time

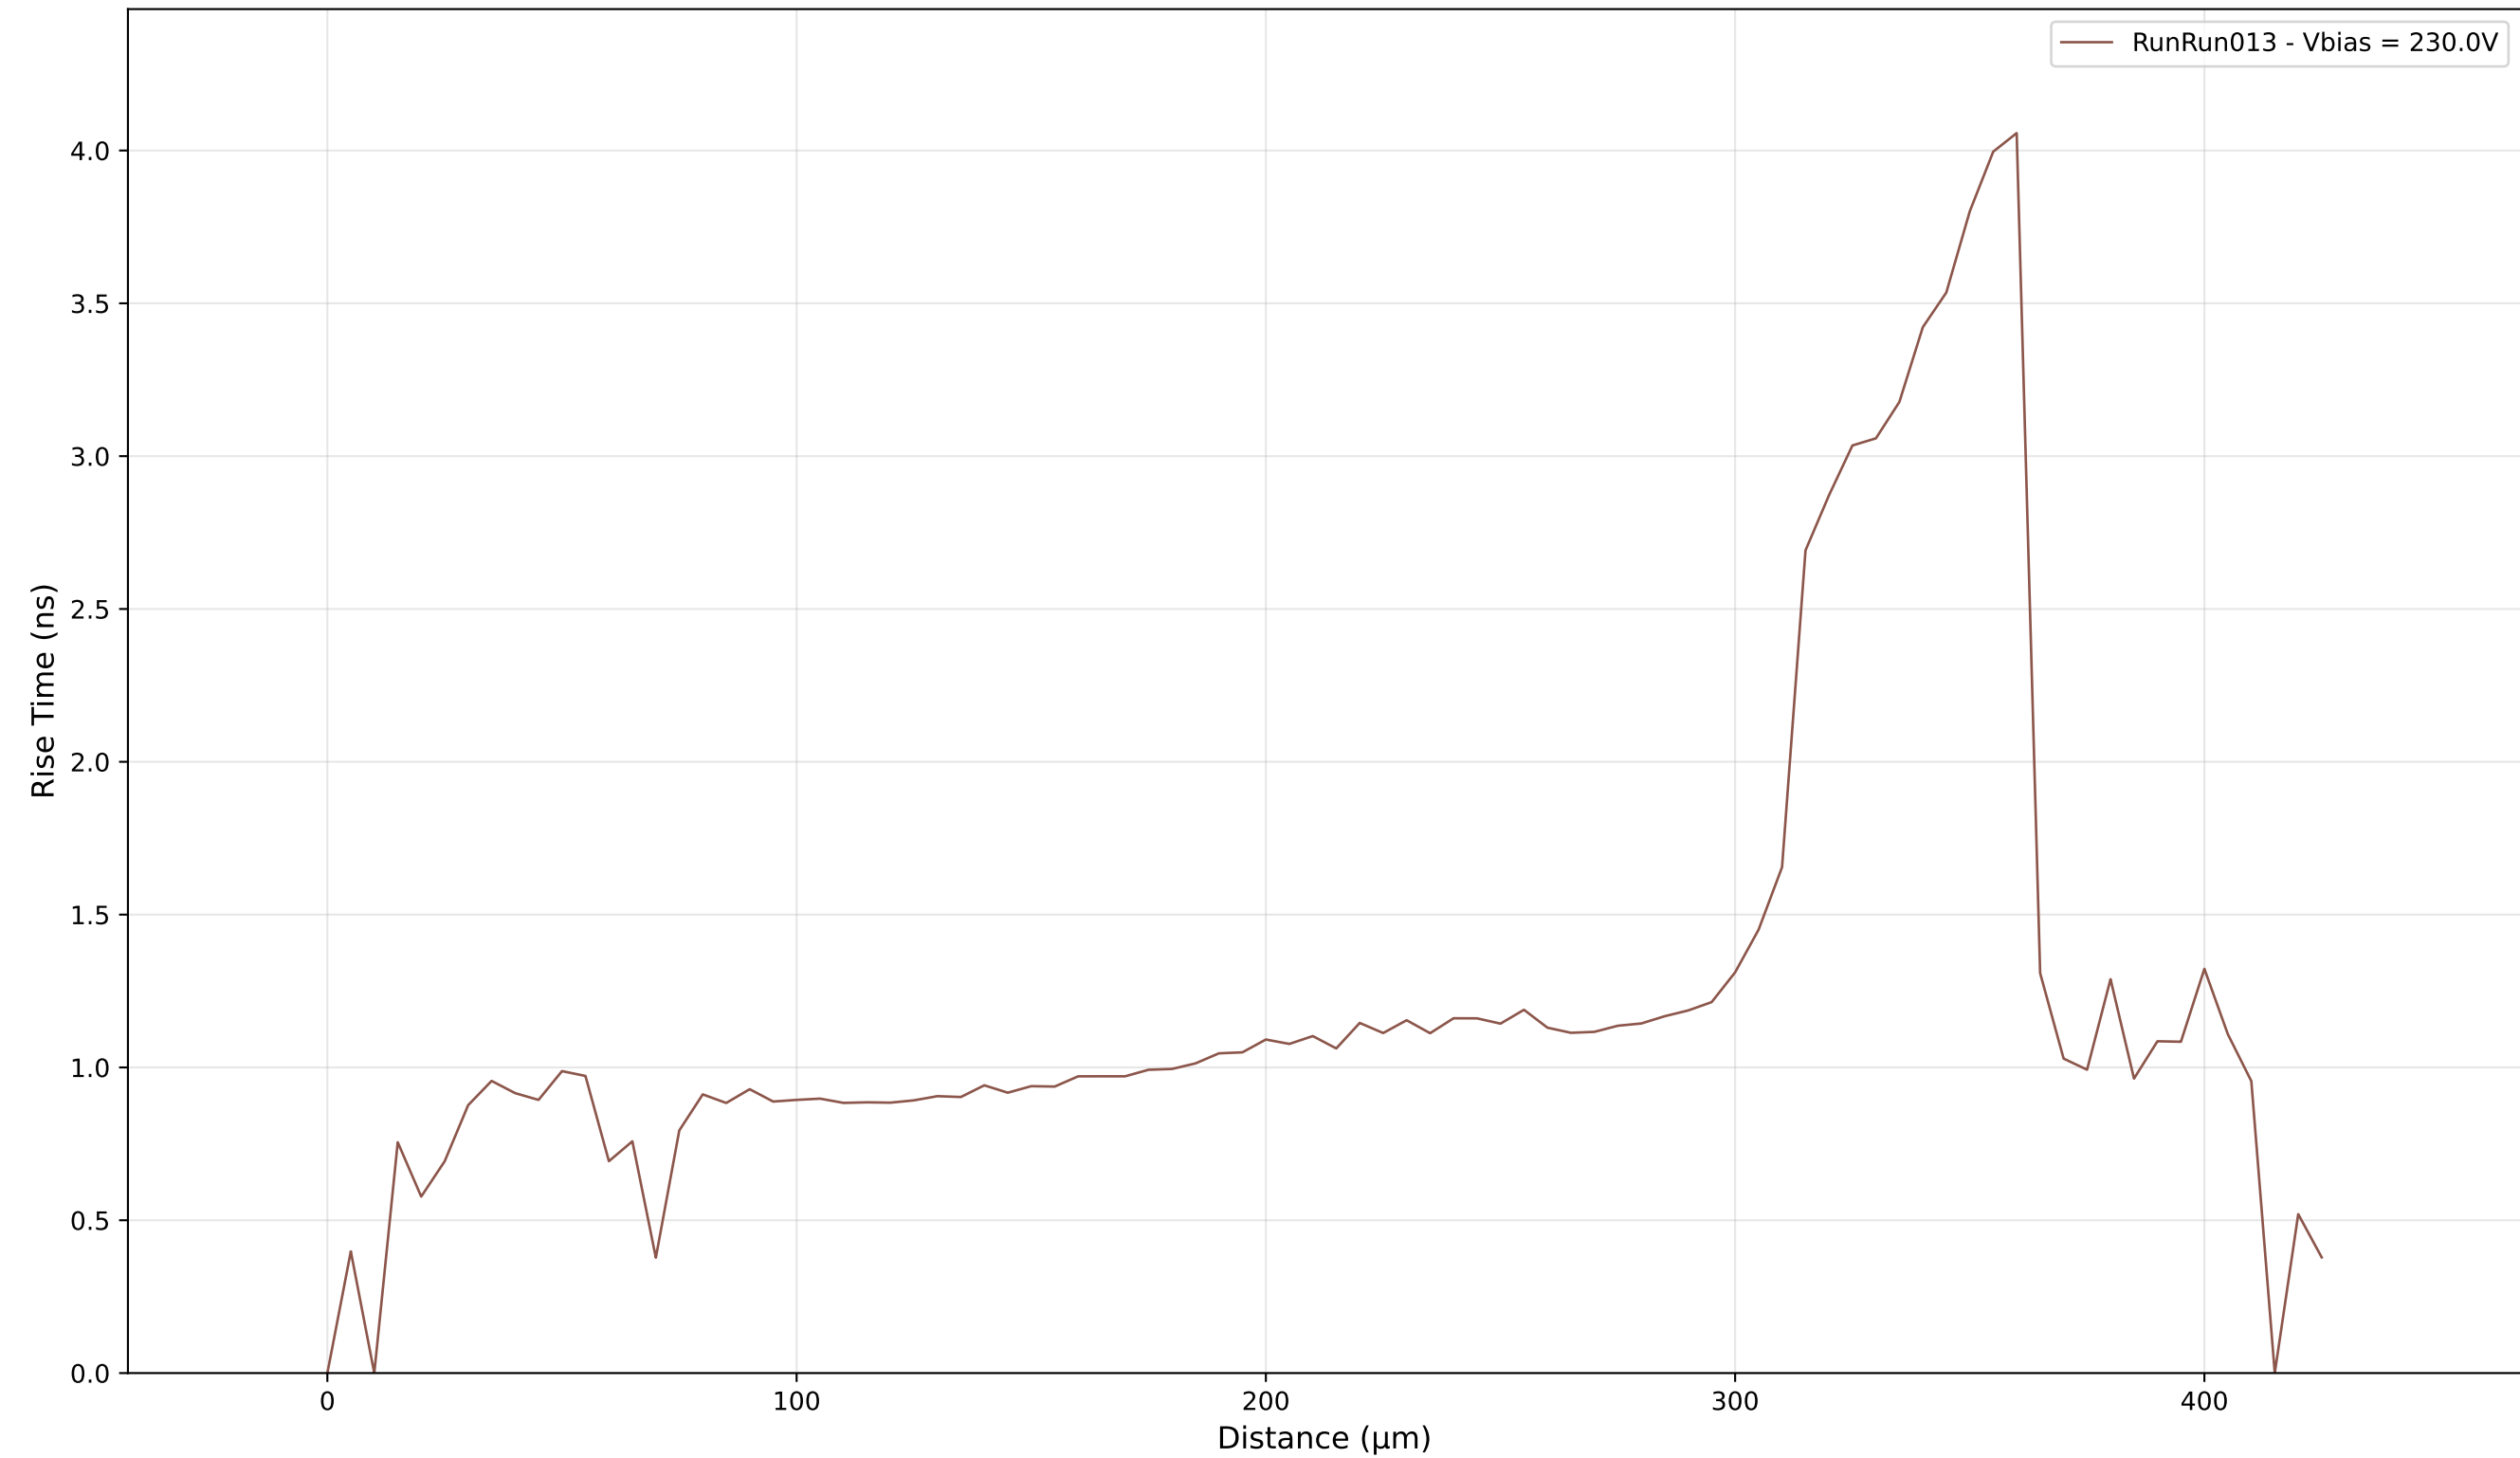


Amplitude

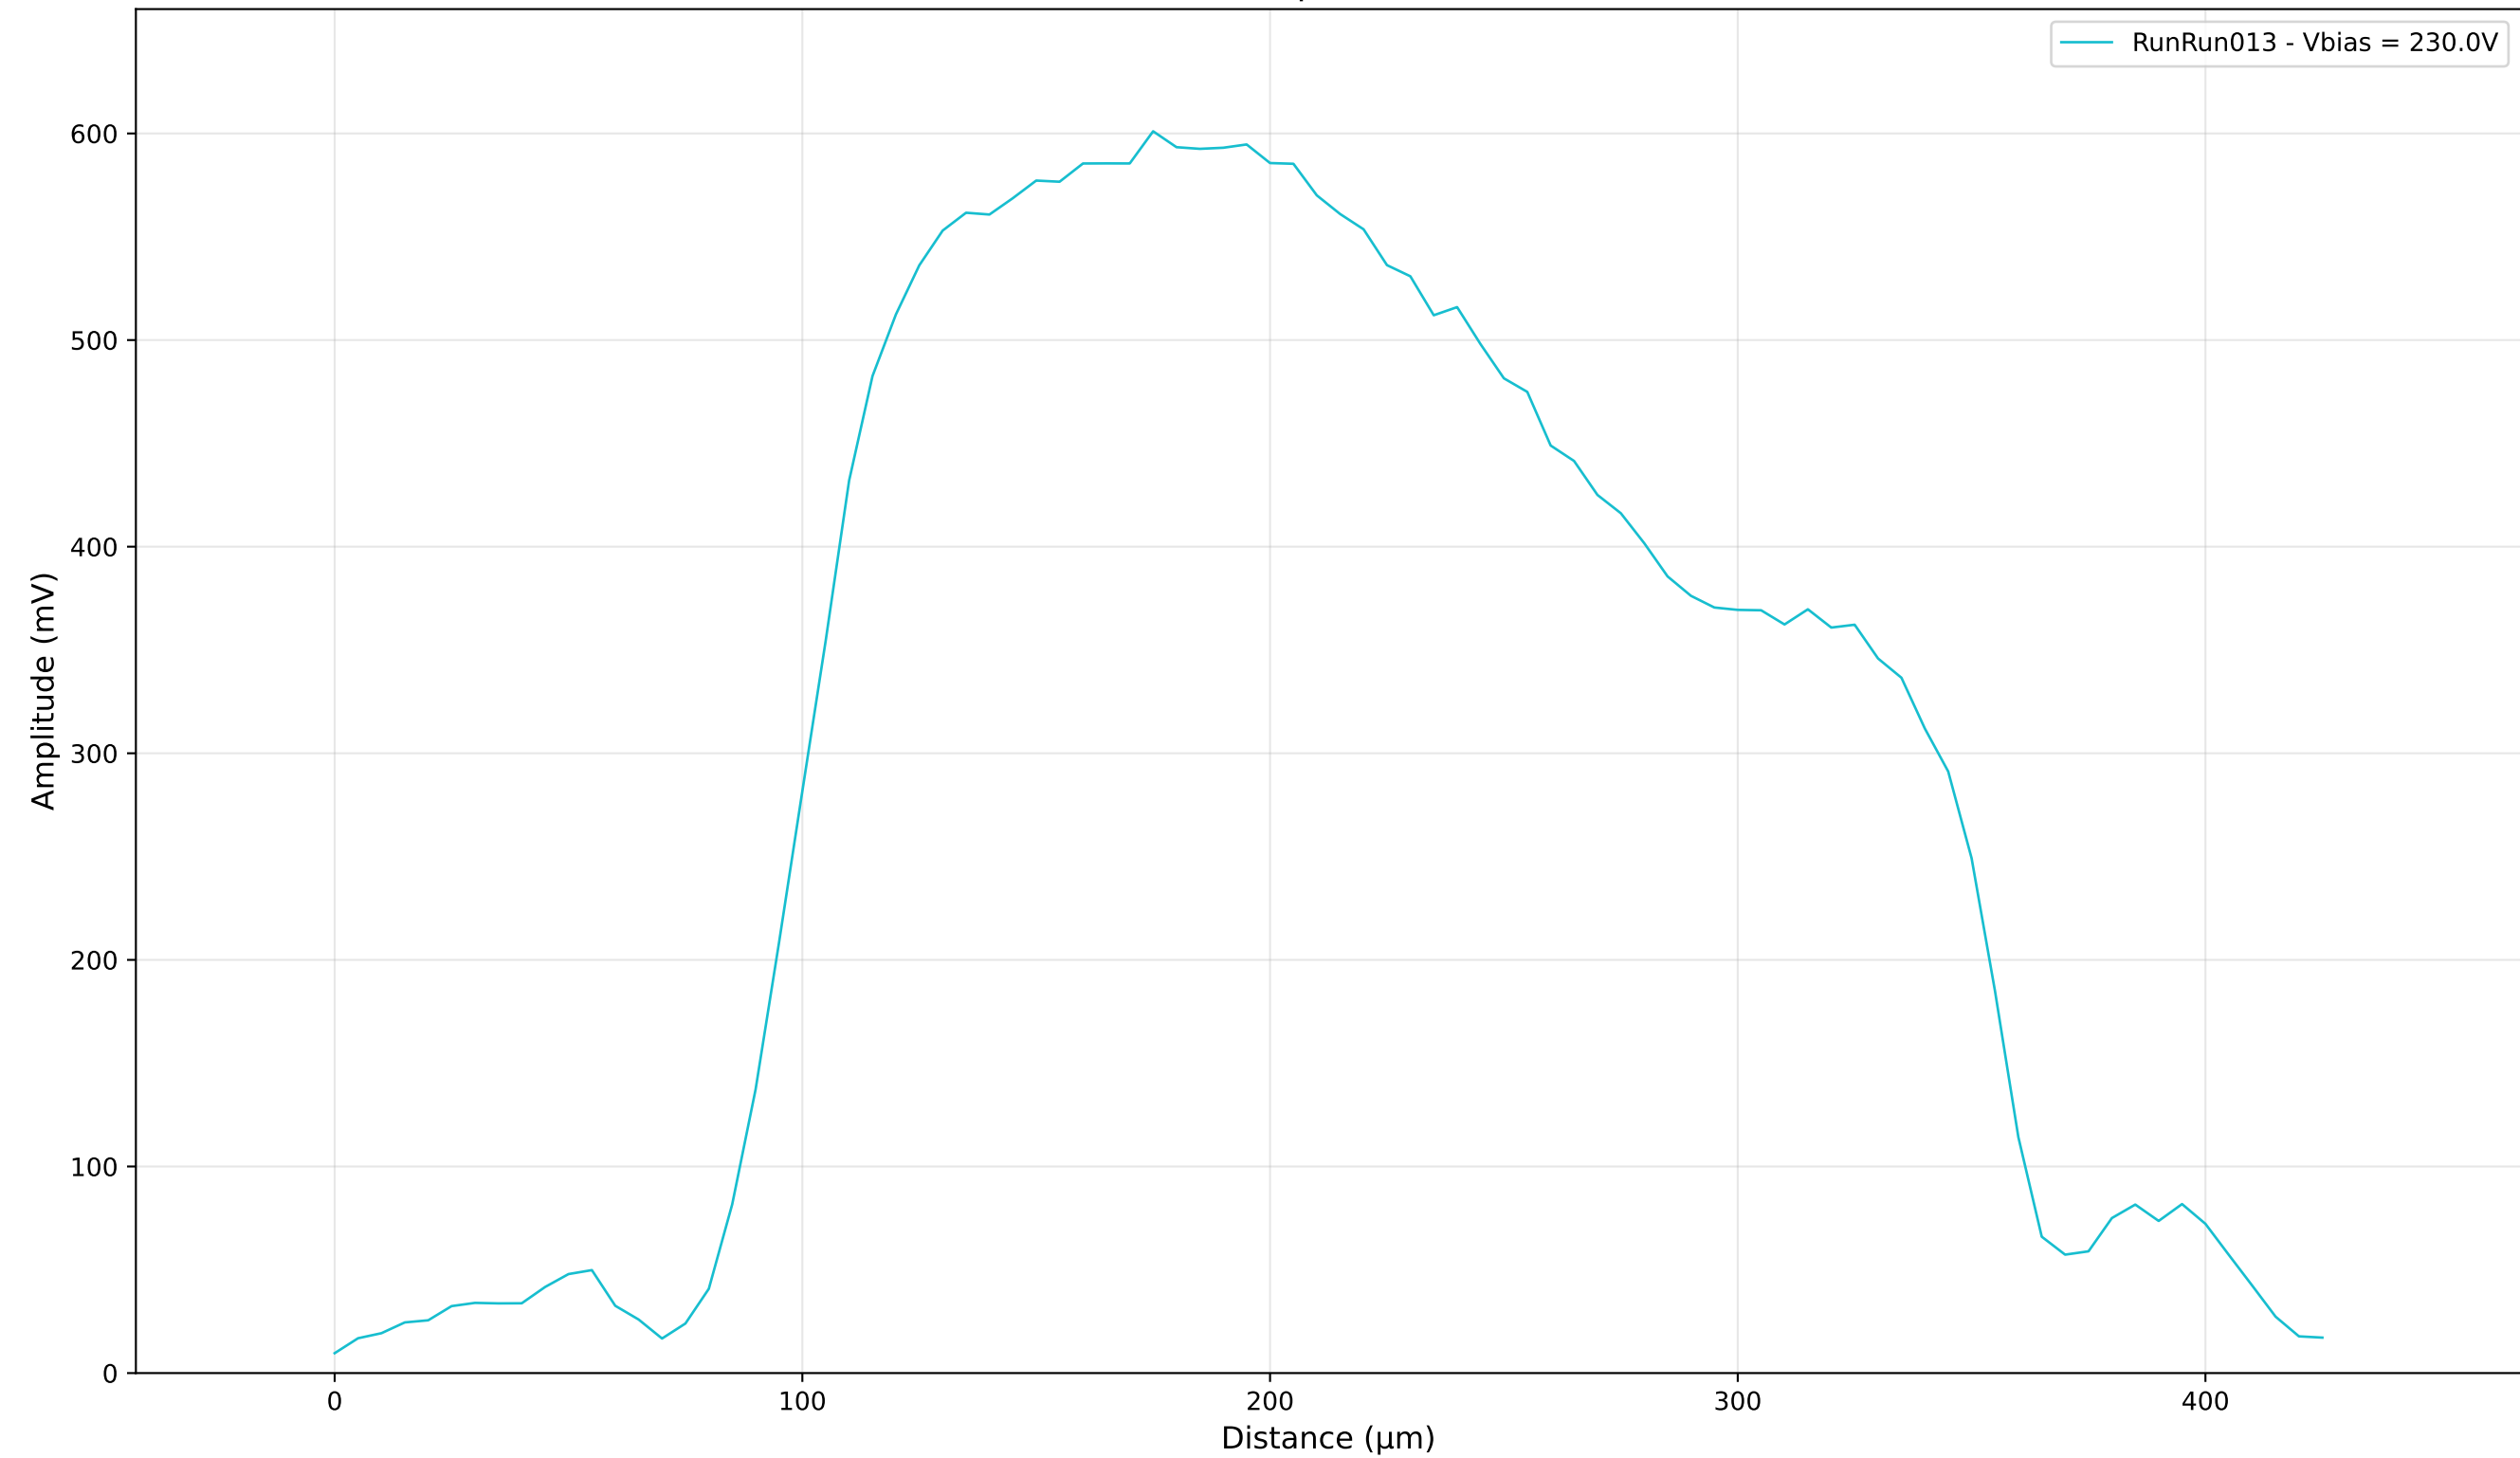


FWHM

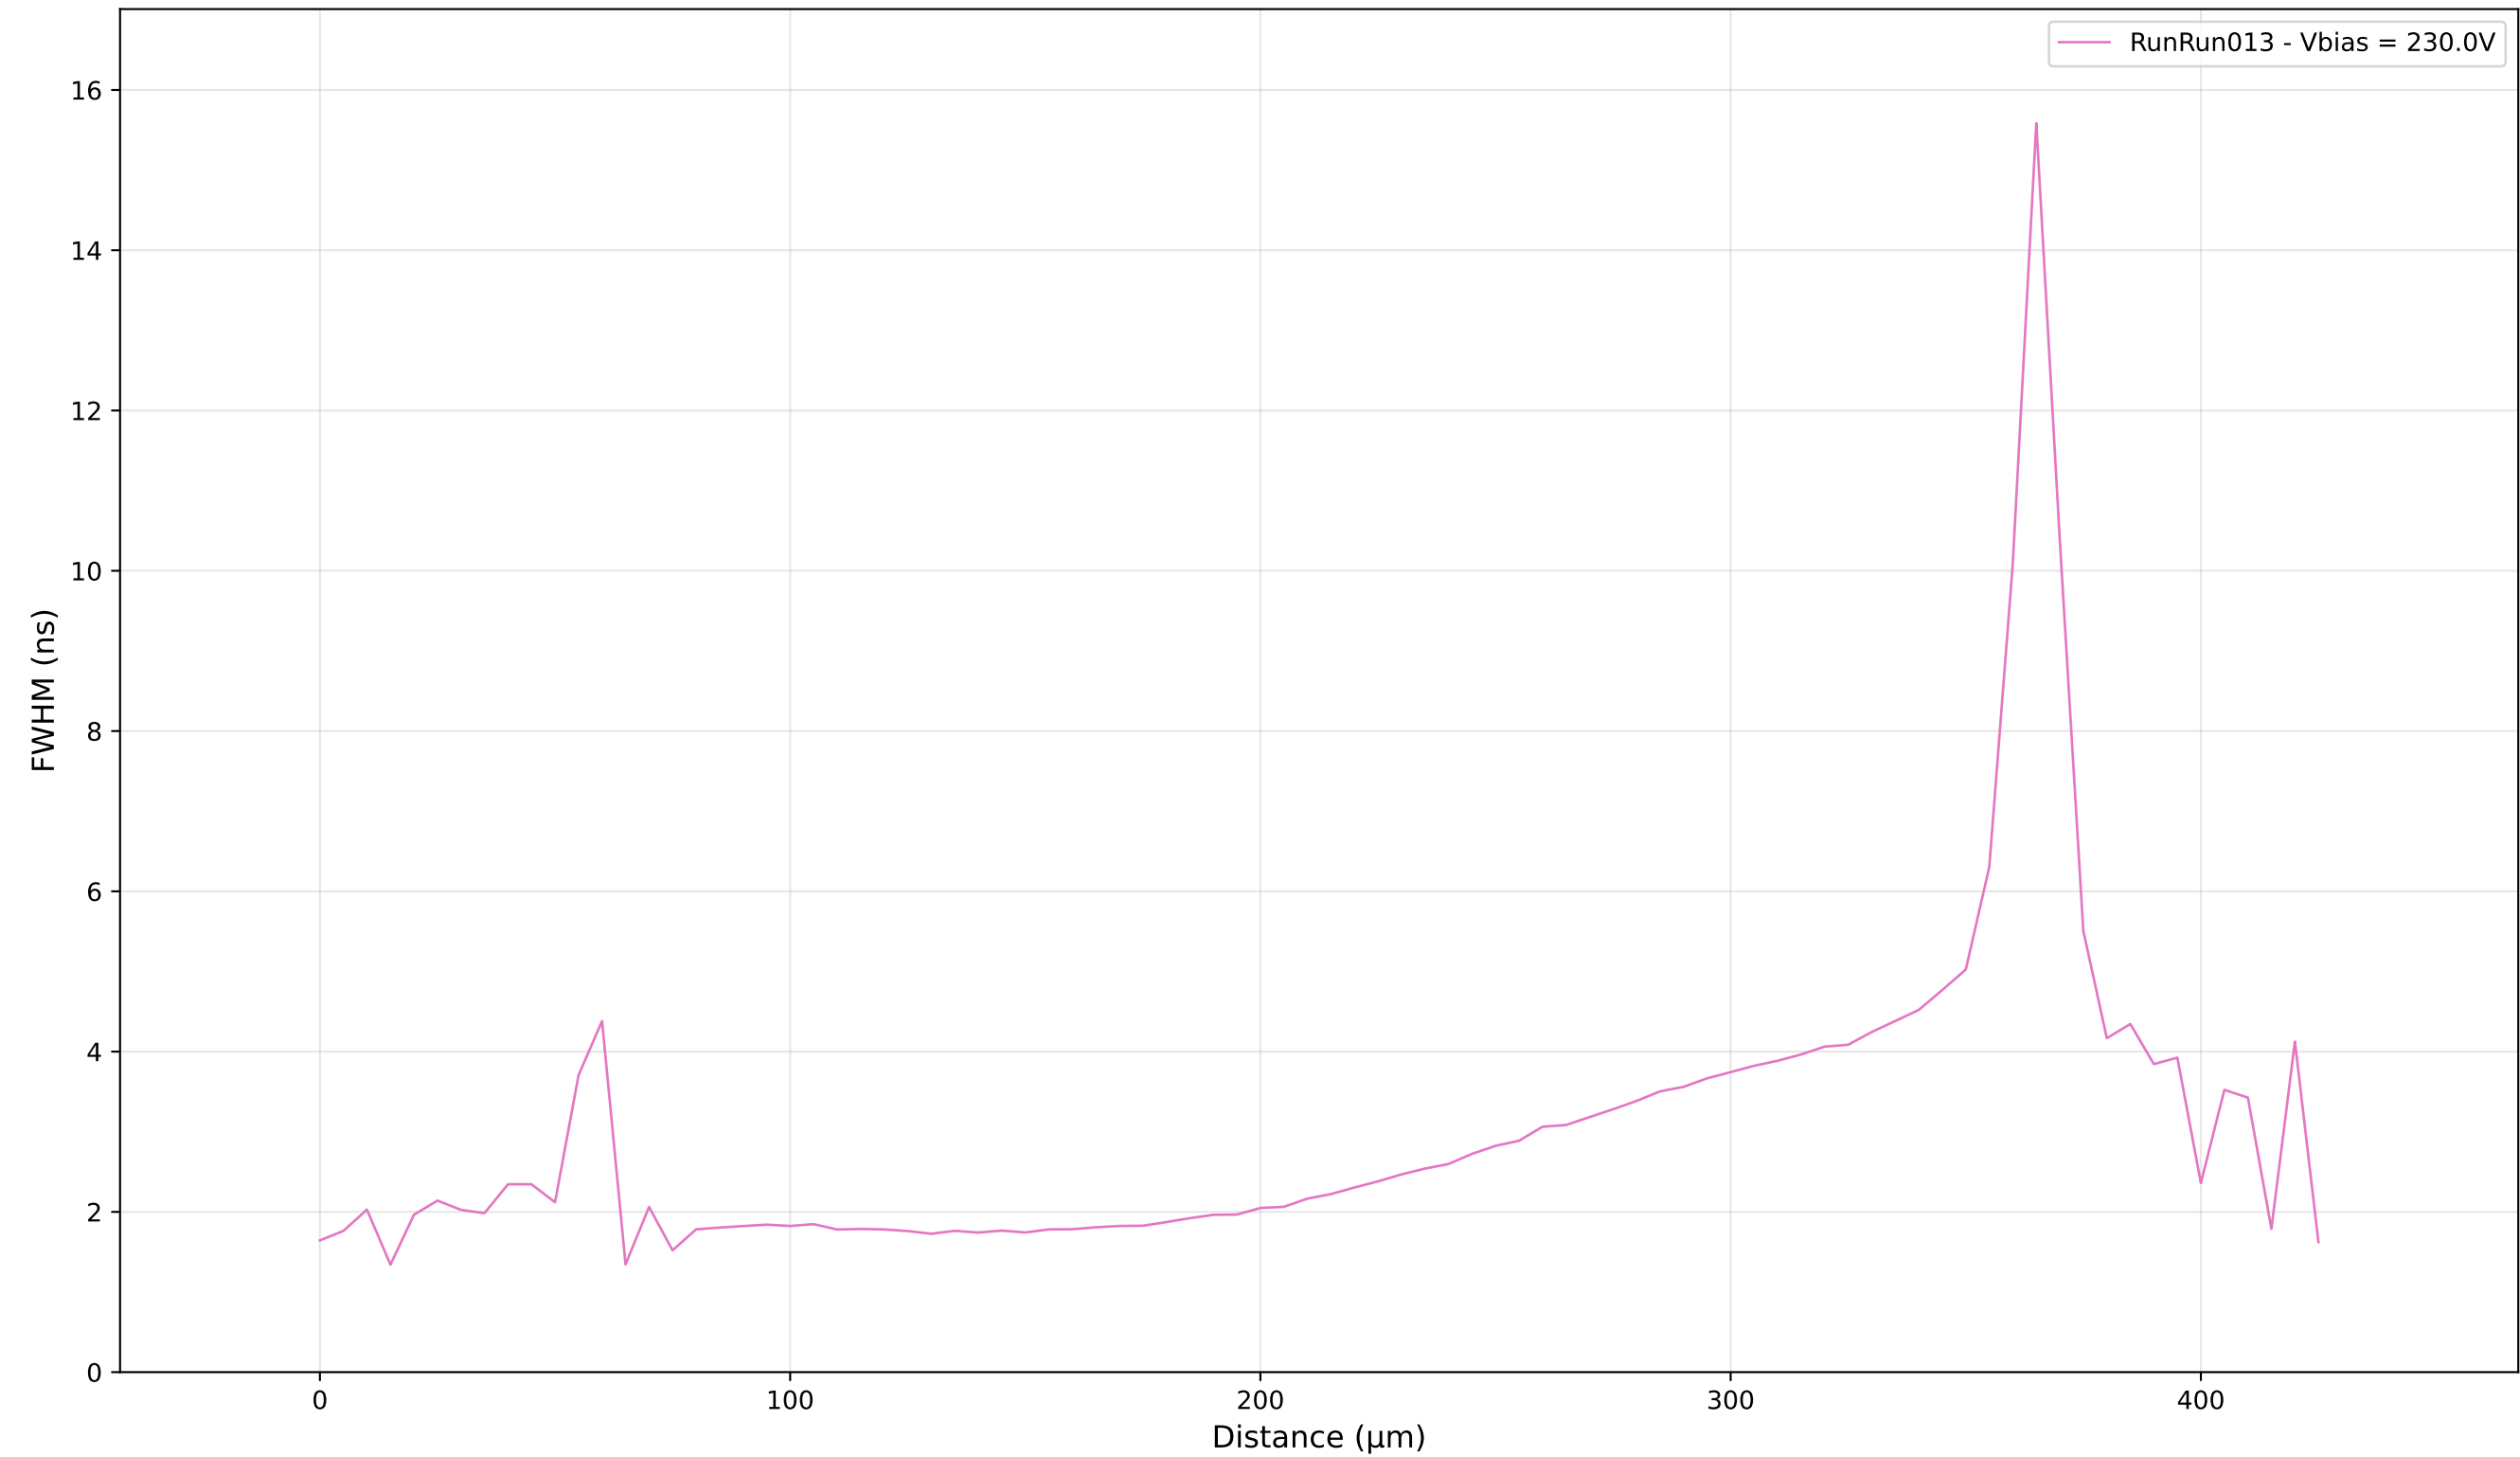


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 0.62 pC - Rise Time: 0.00 ns (N/A)

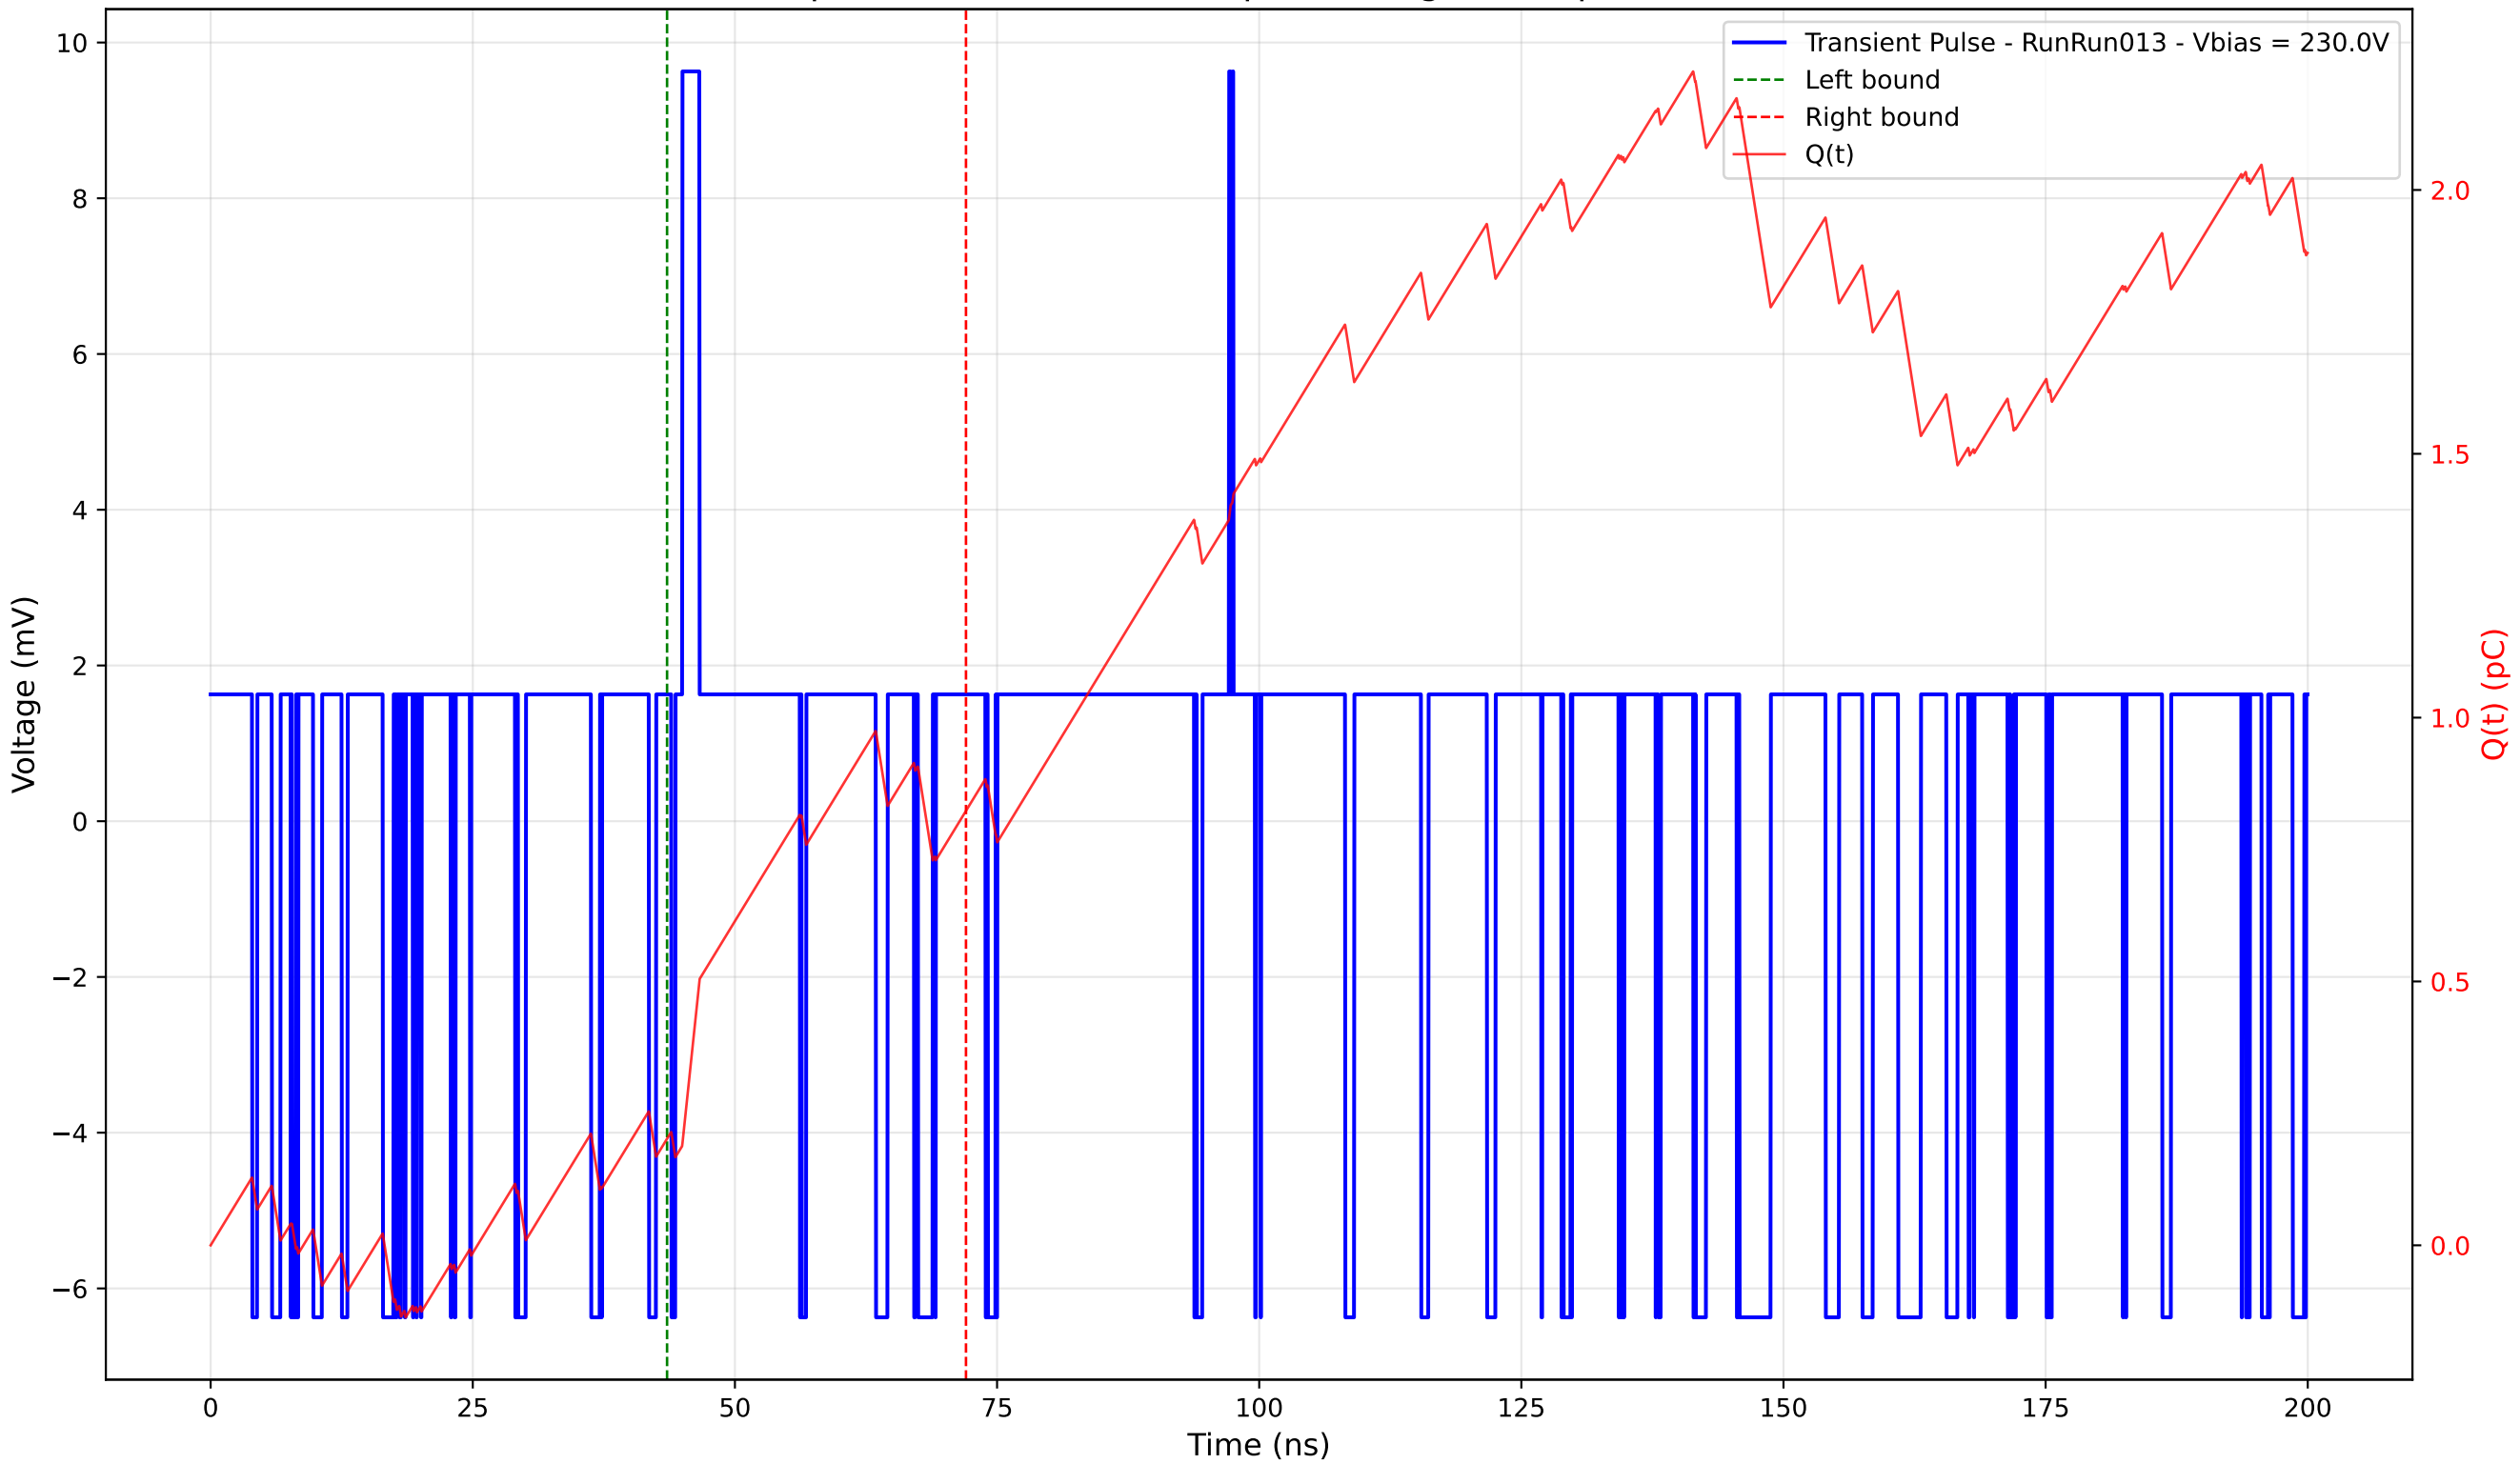


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 0.52 pC - Rise Time: 0.40 ns

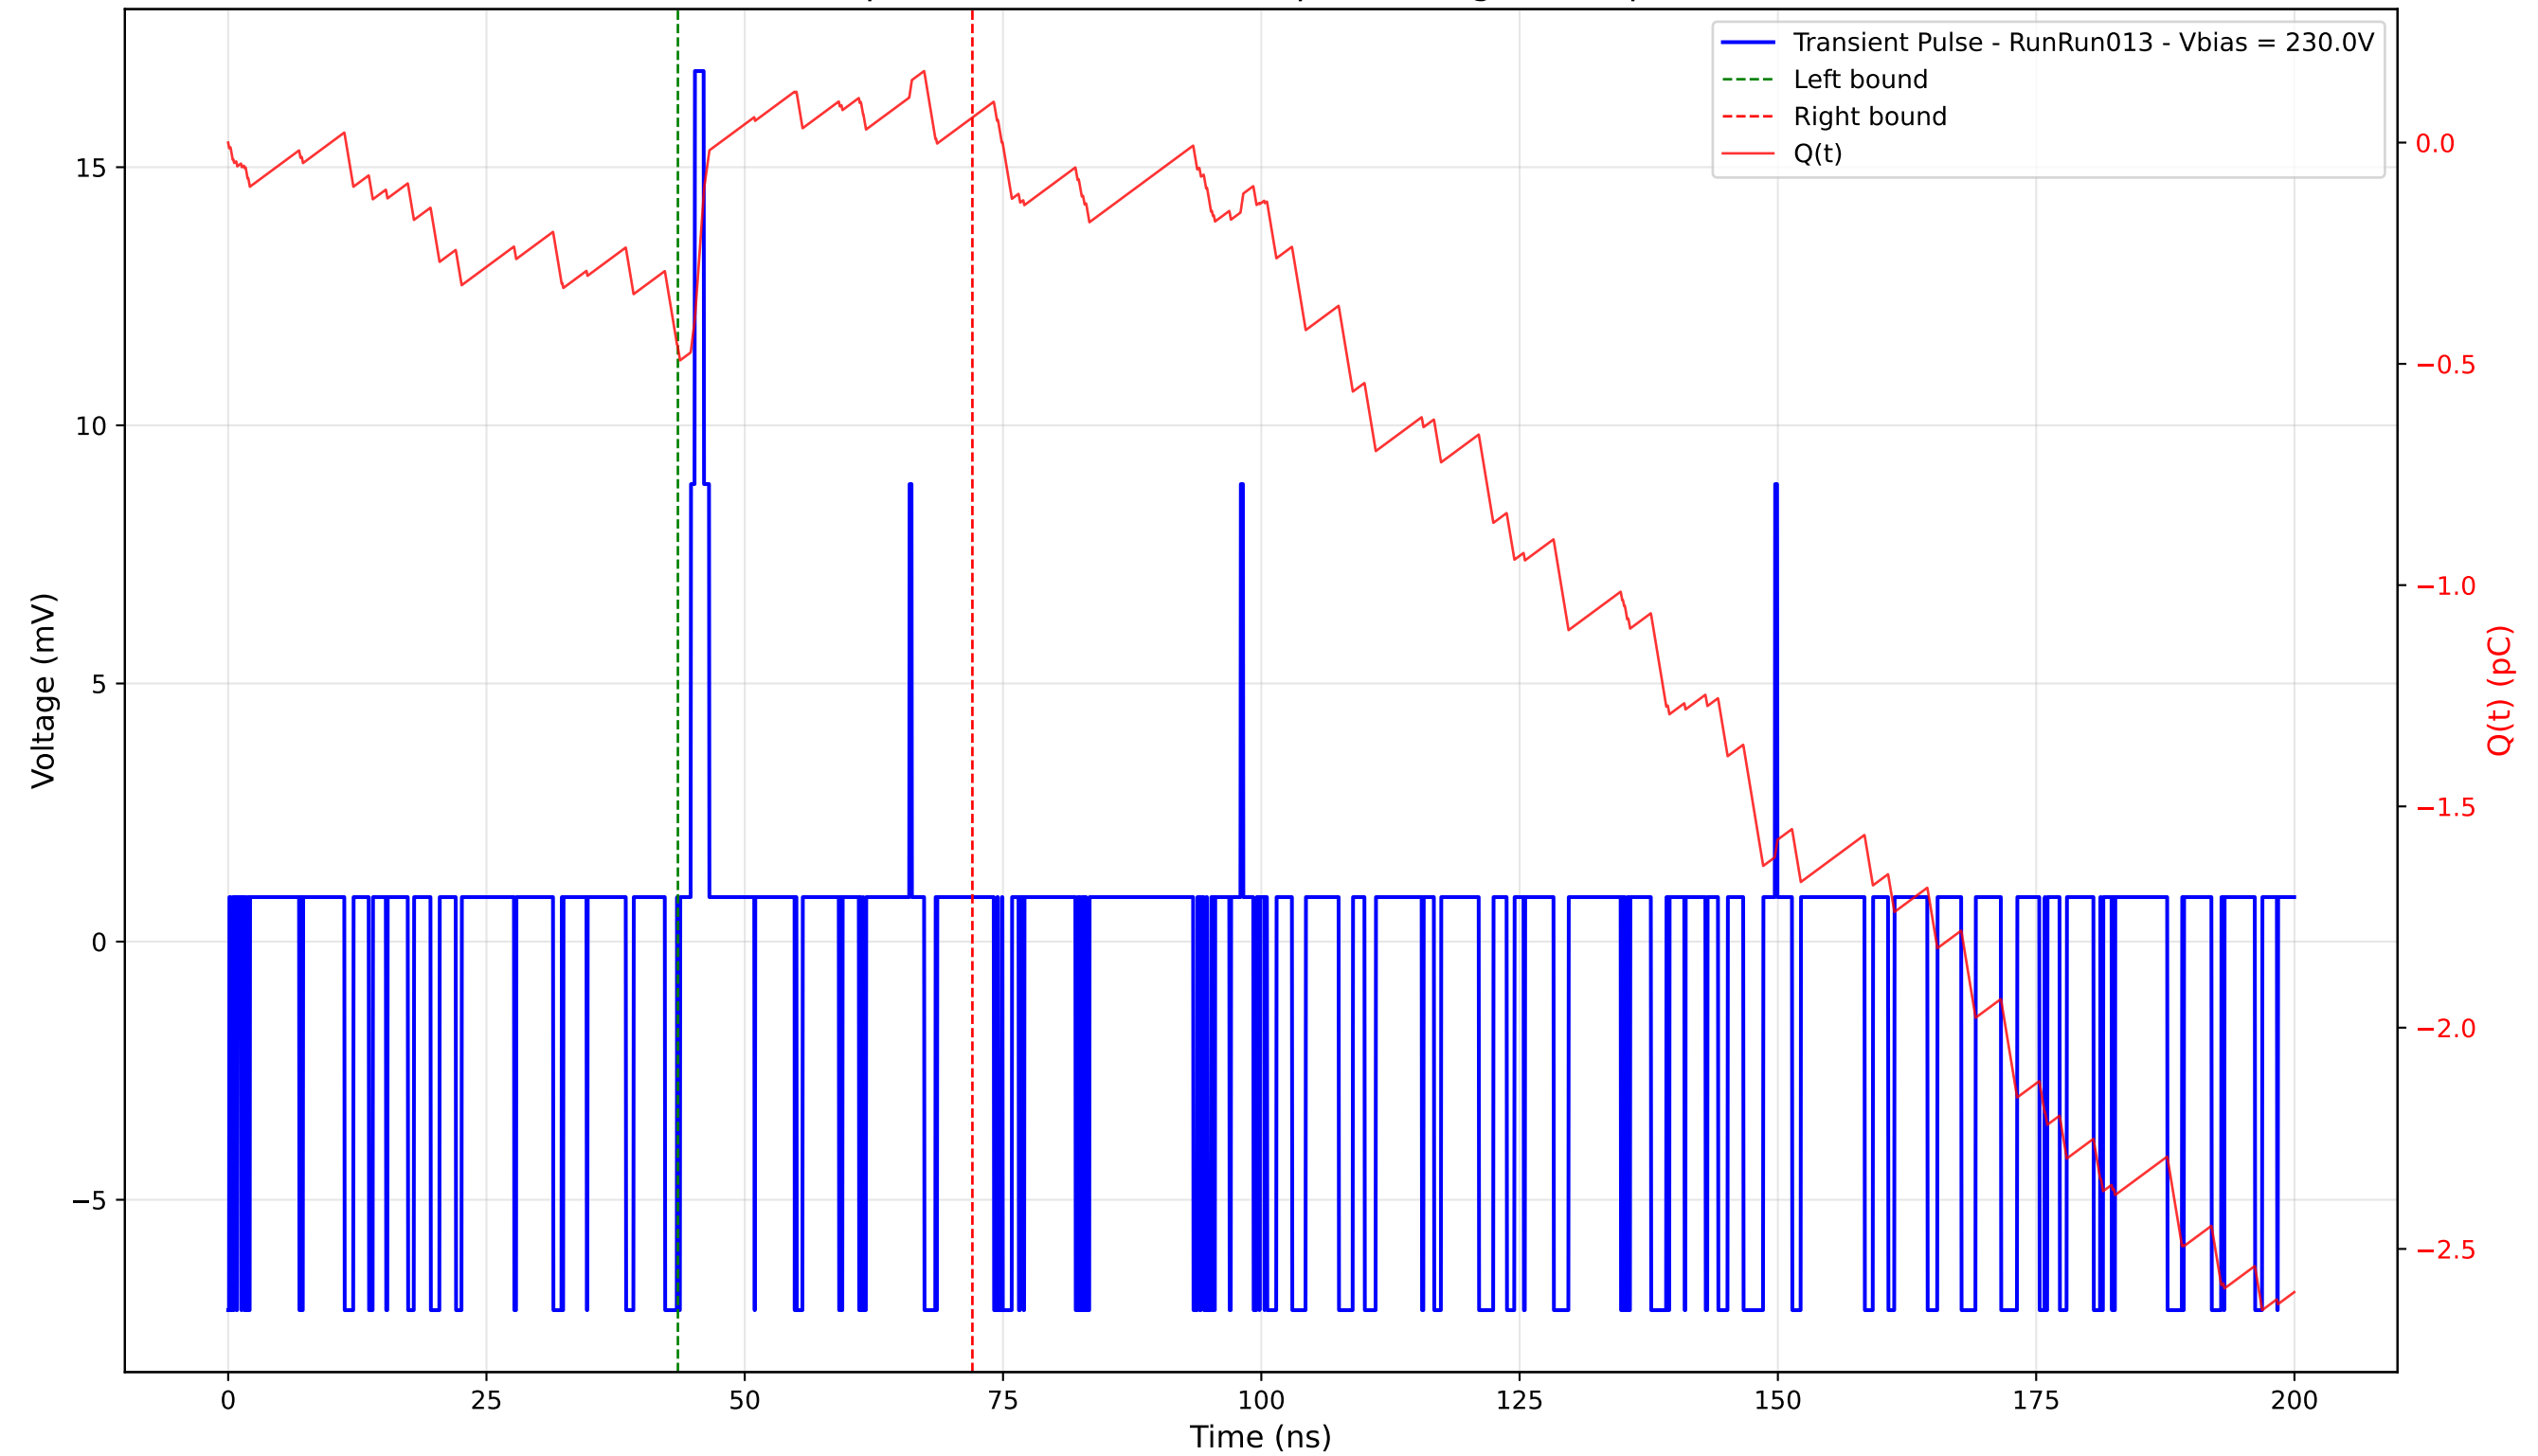


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 1.85 pC - Rise Time: 0.00 ns (N/A)

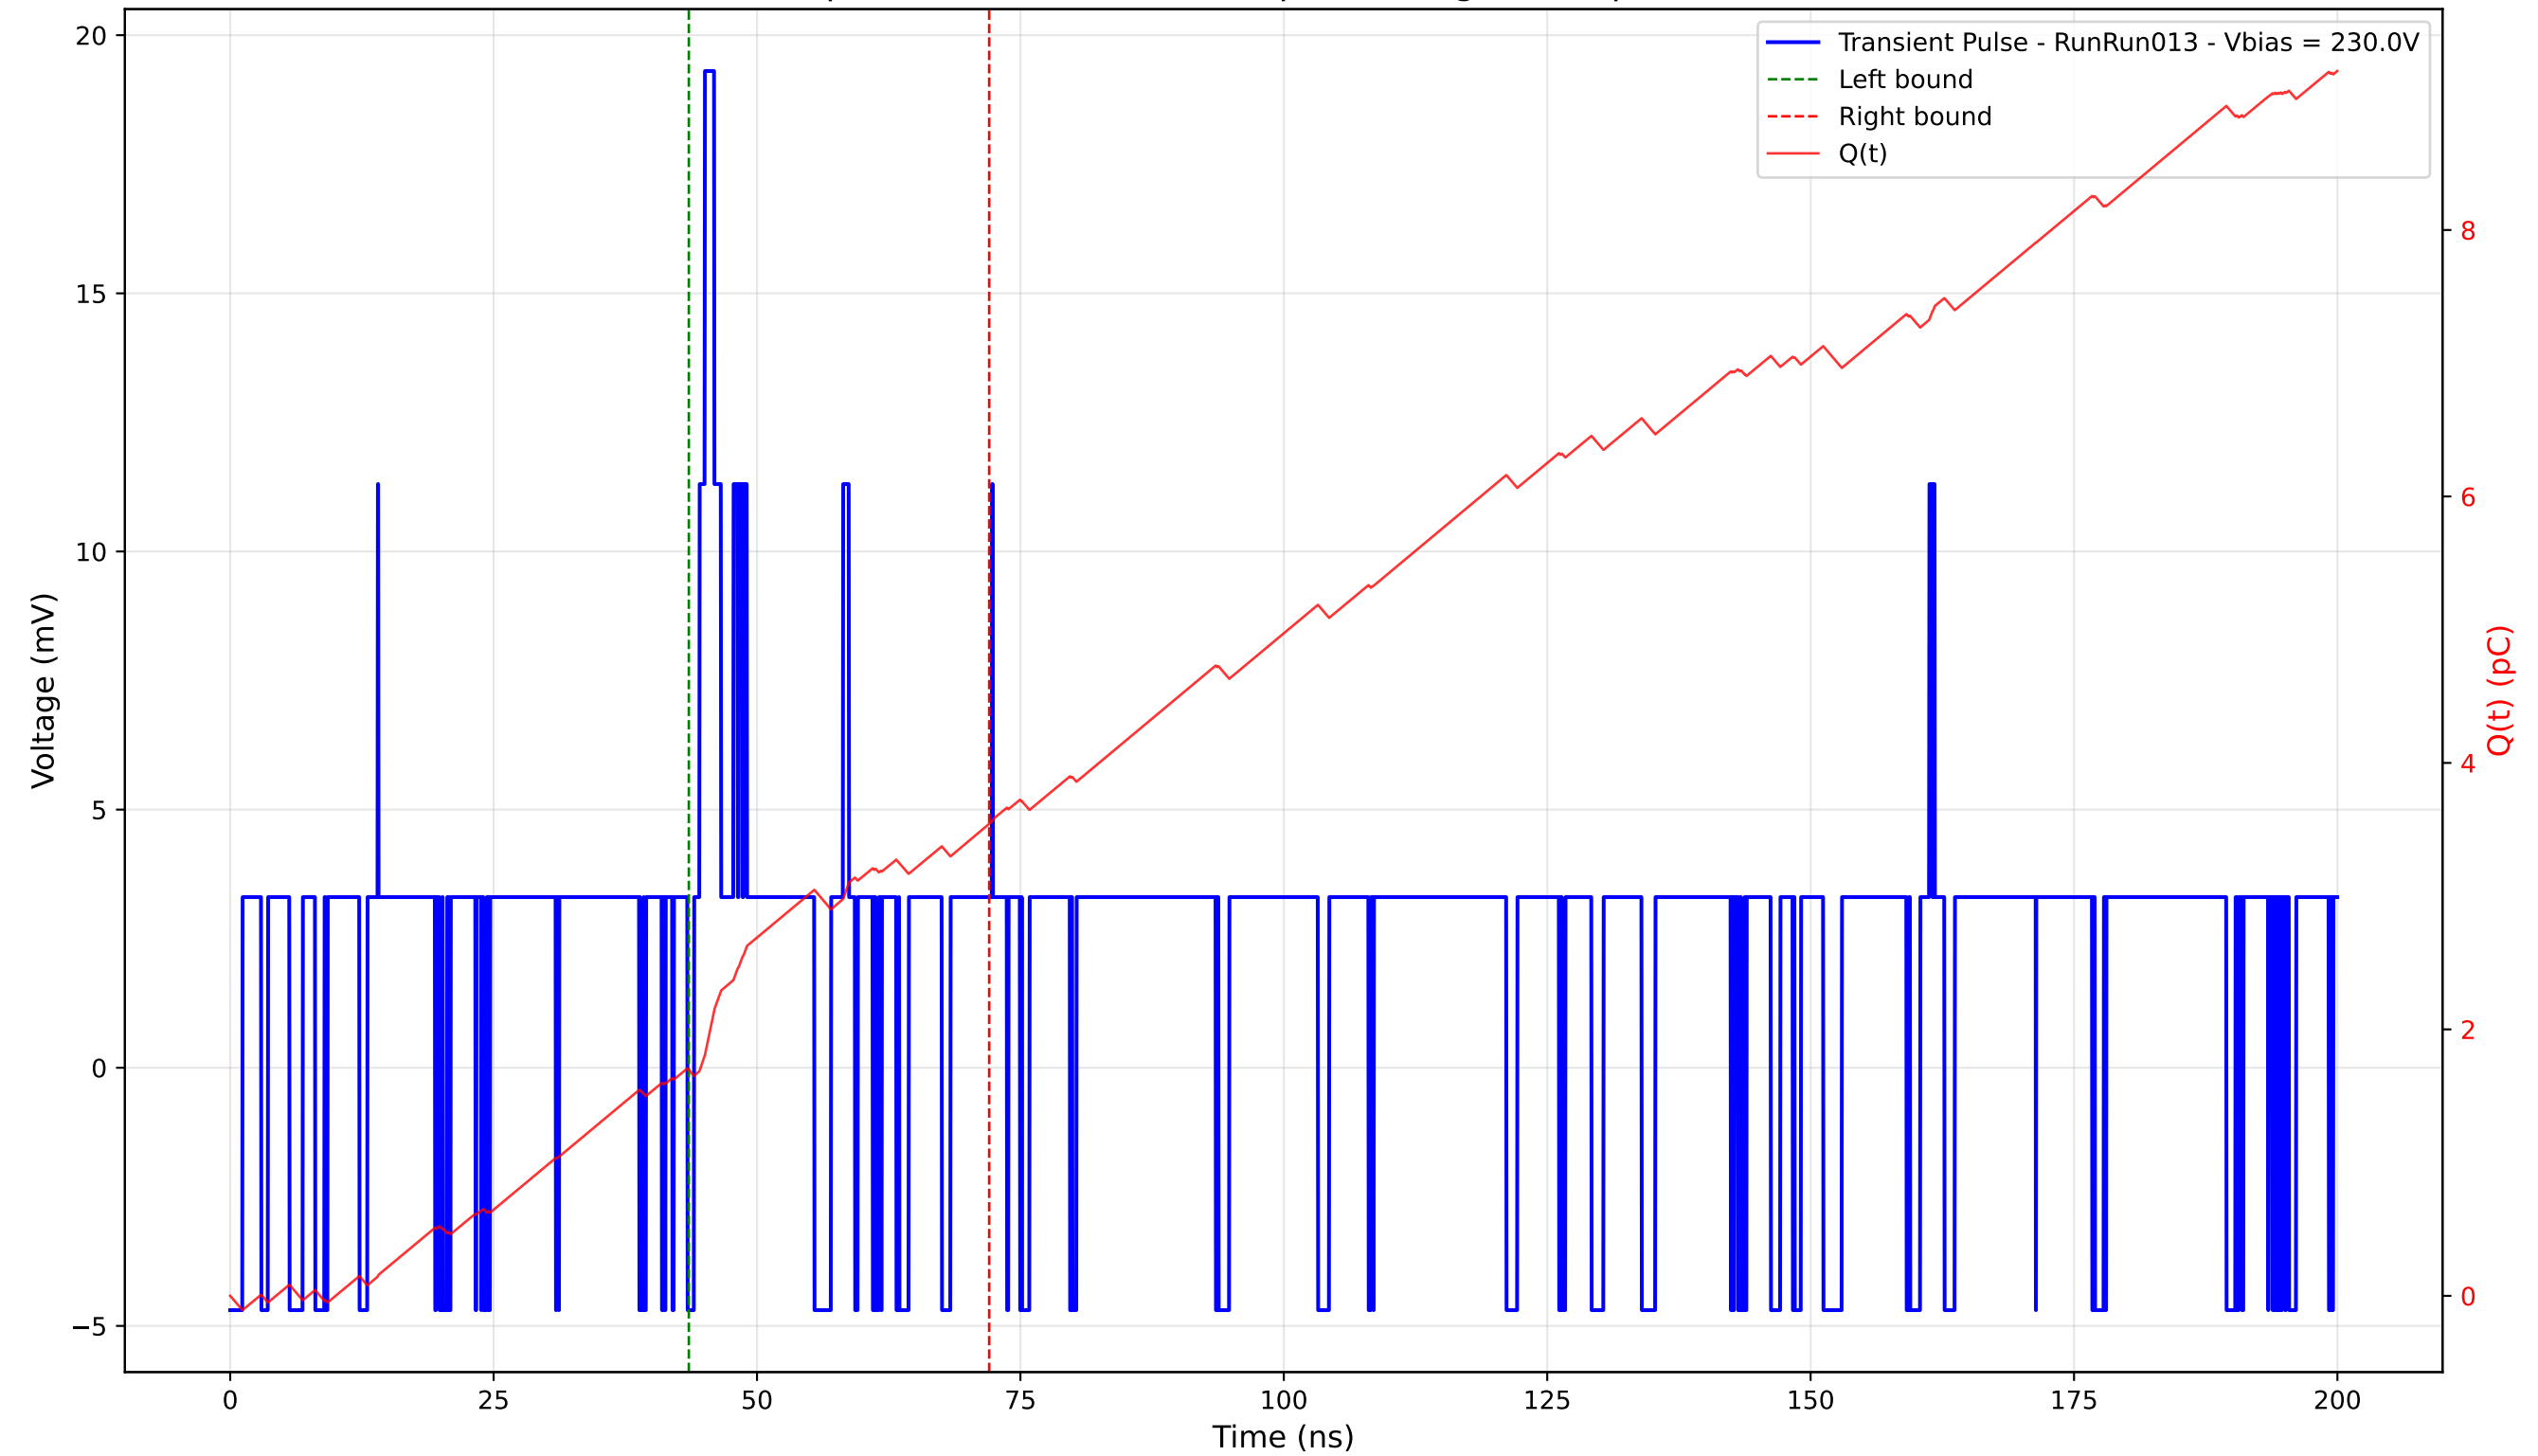


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 0.82 pC - Rise Time: 0.76 ns

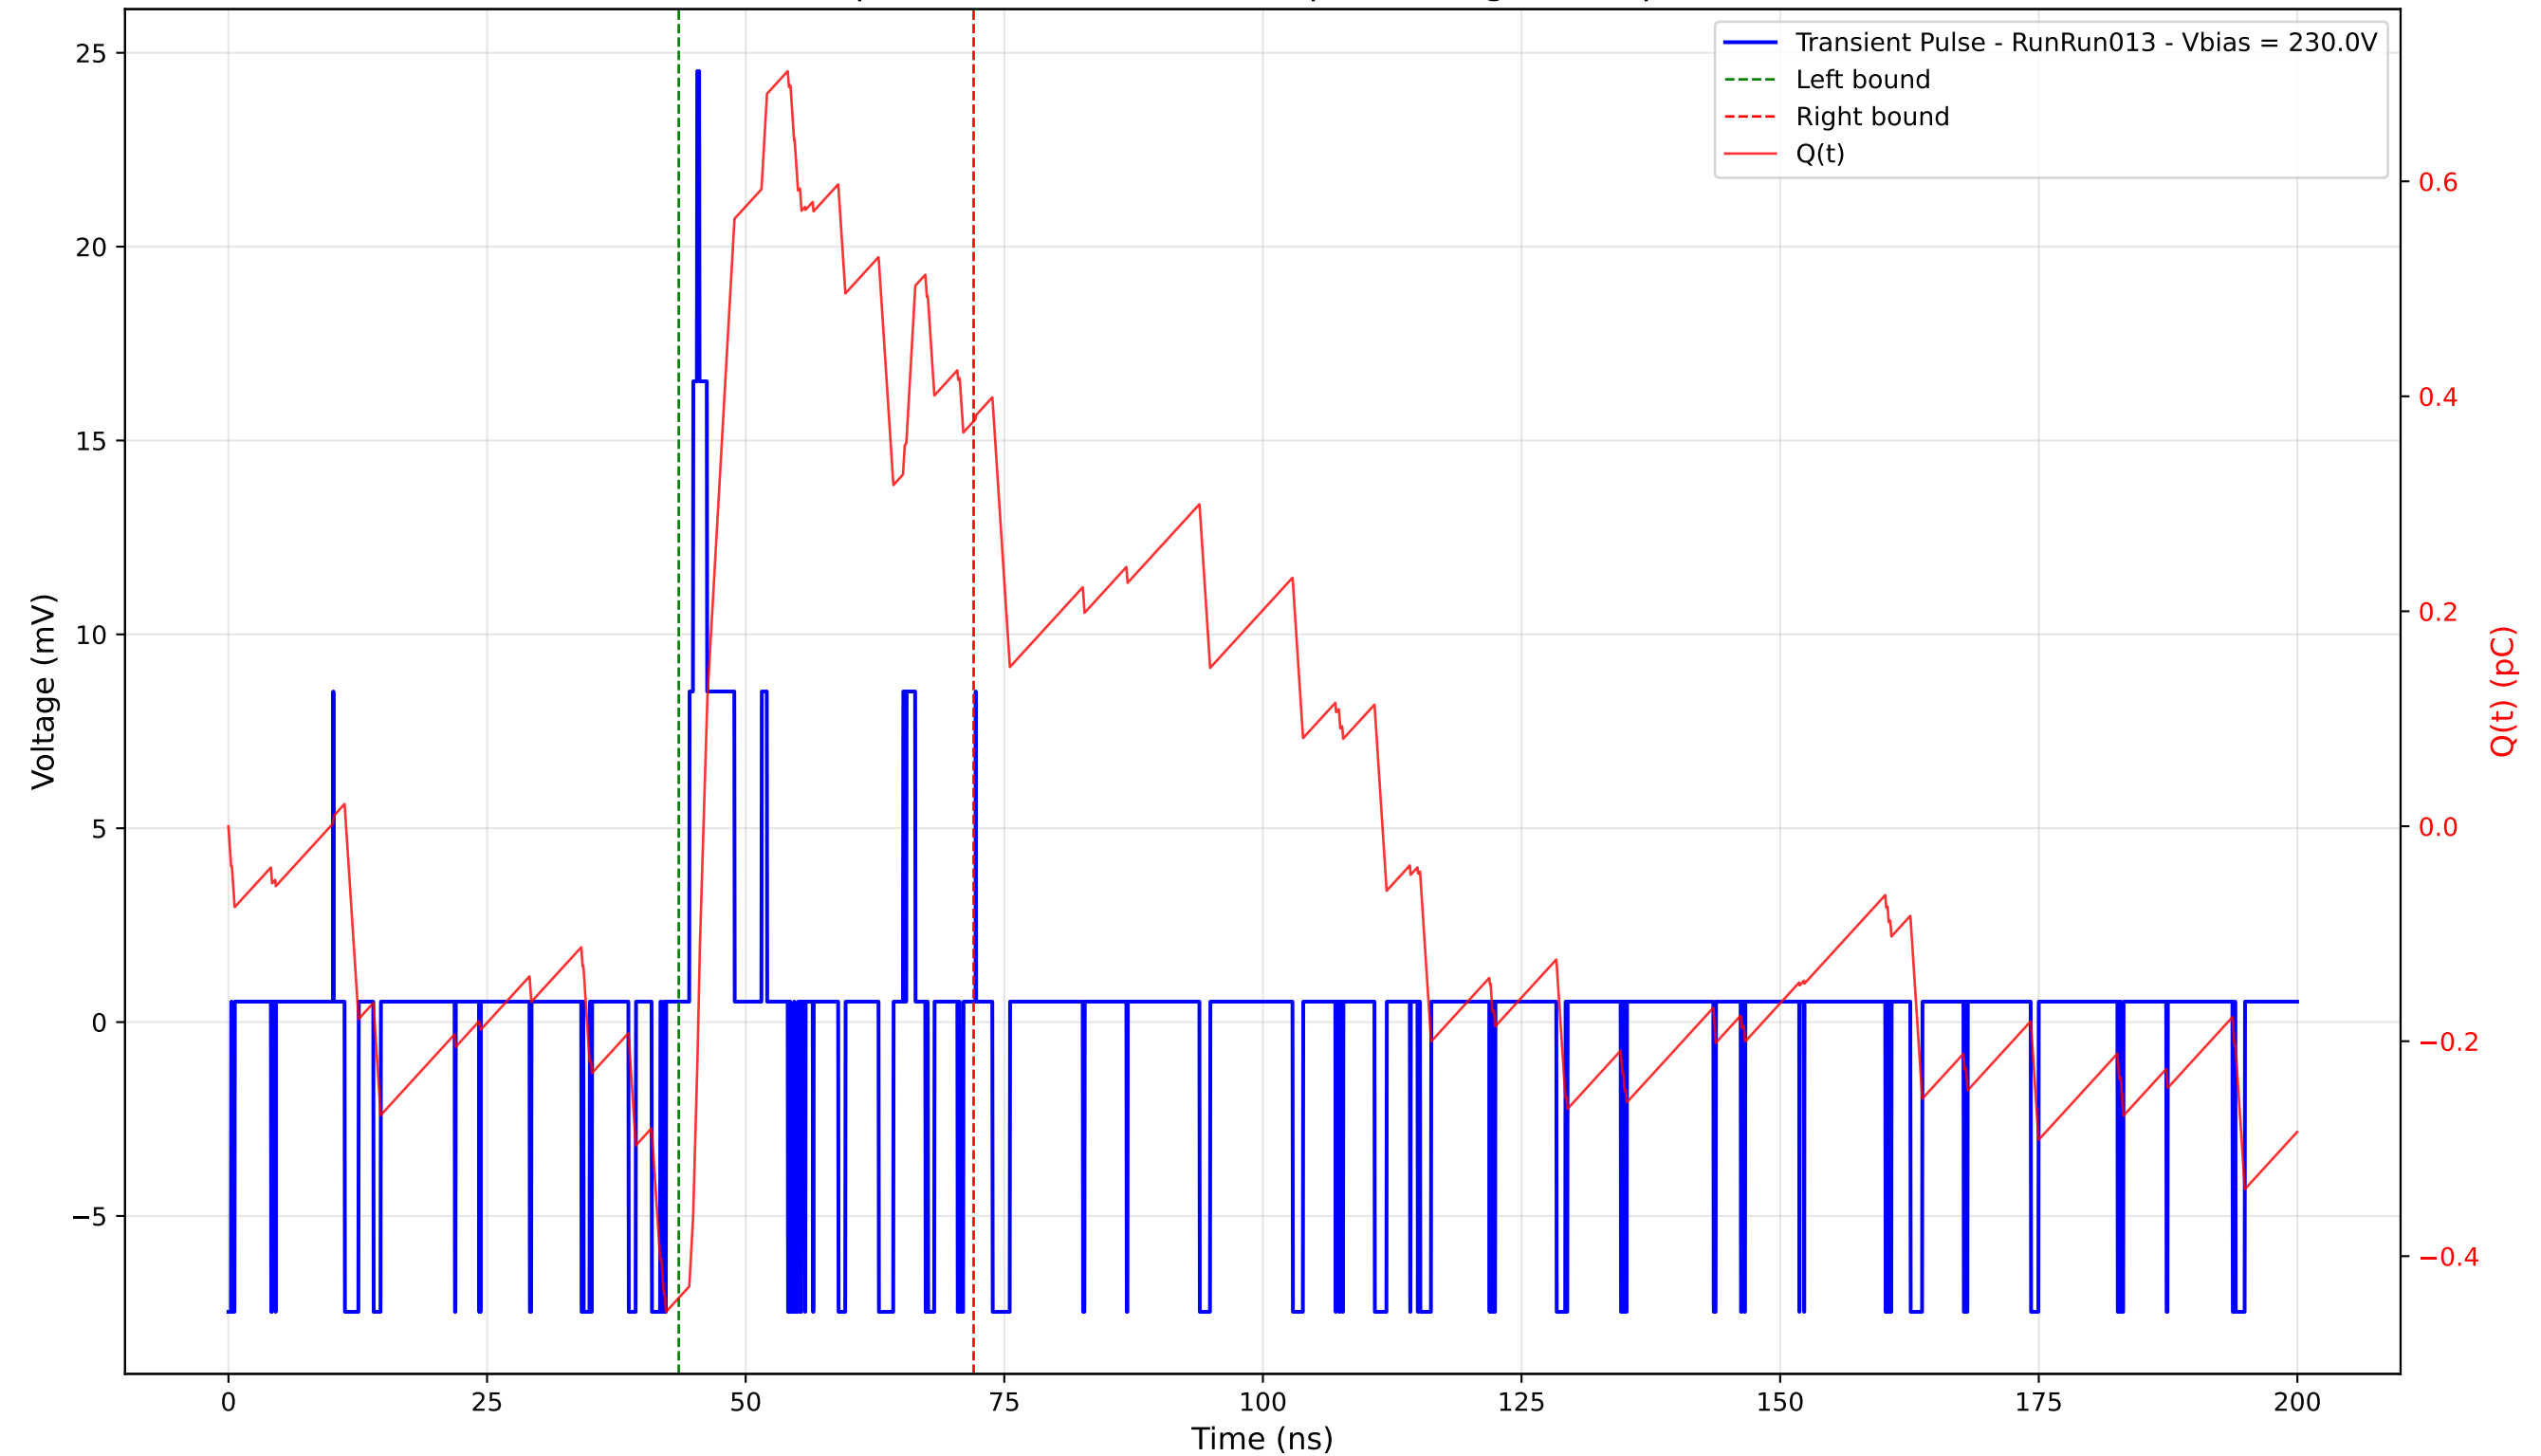


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.21 pC - Rise Time: 0.58 ns

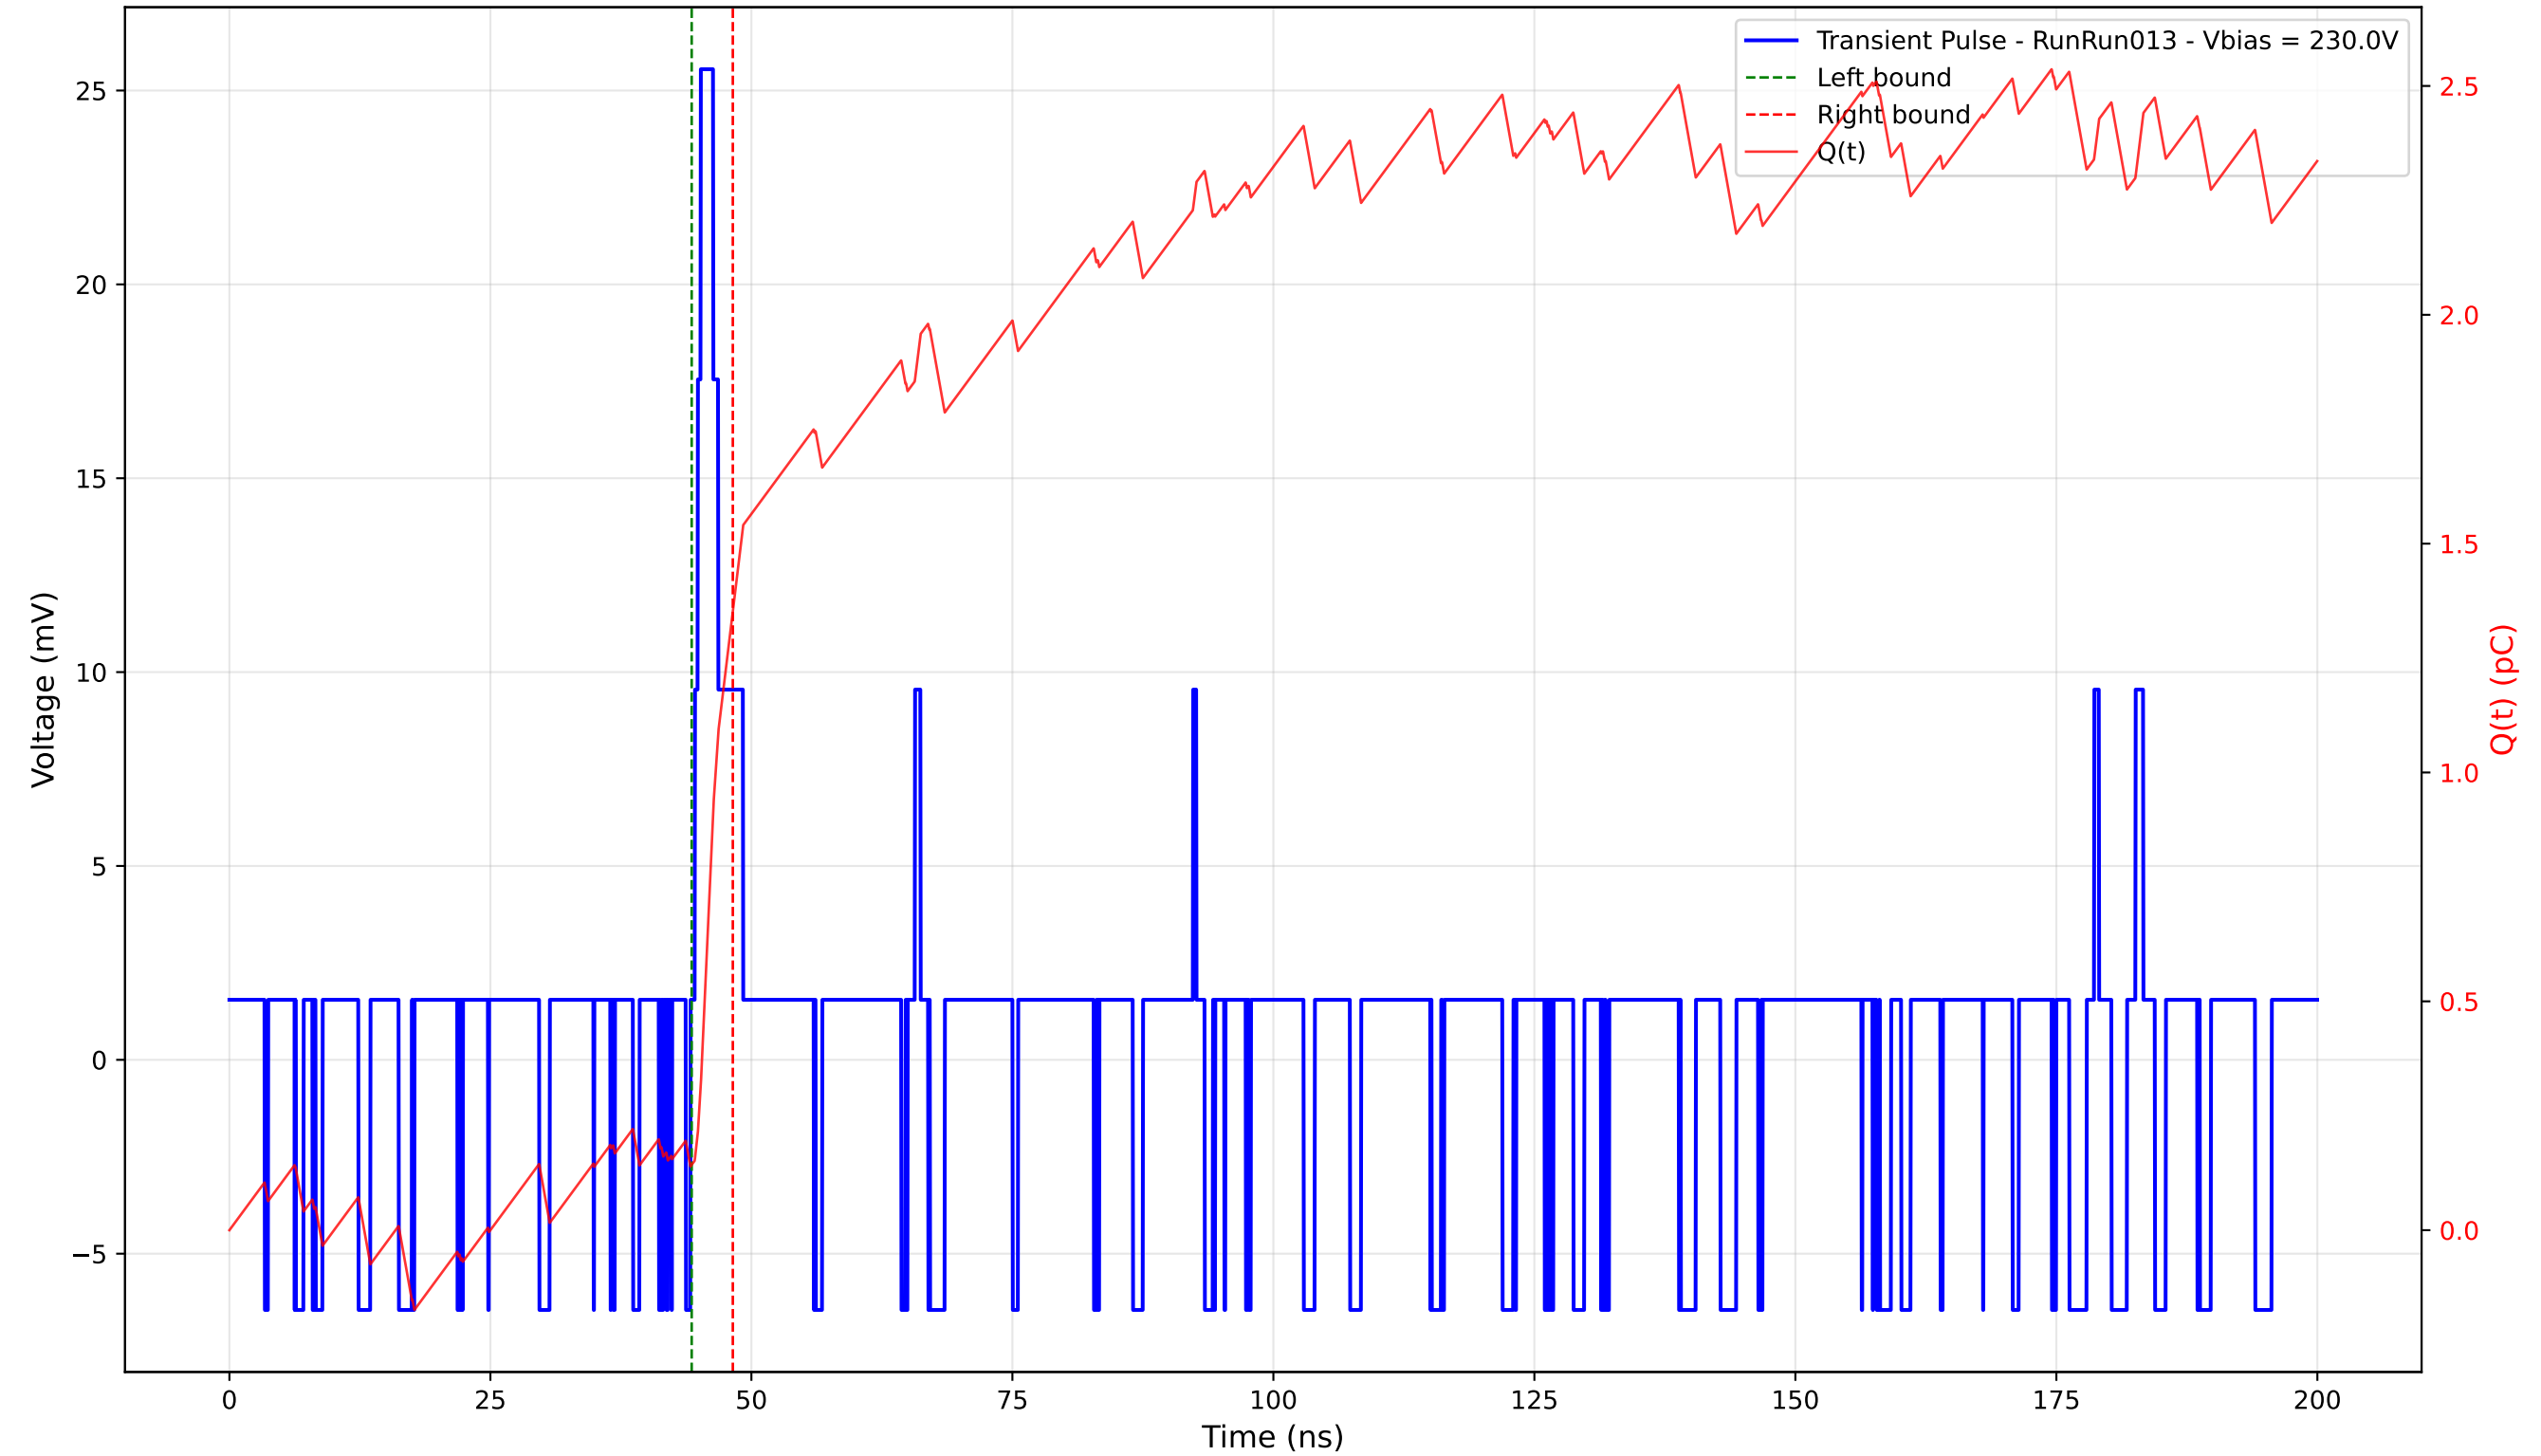


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.53 pC - Rise Time: 0.69 ns

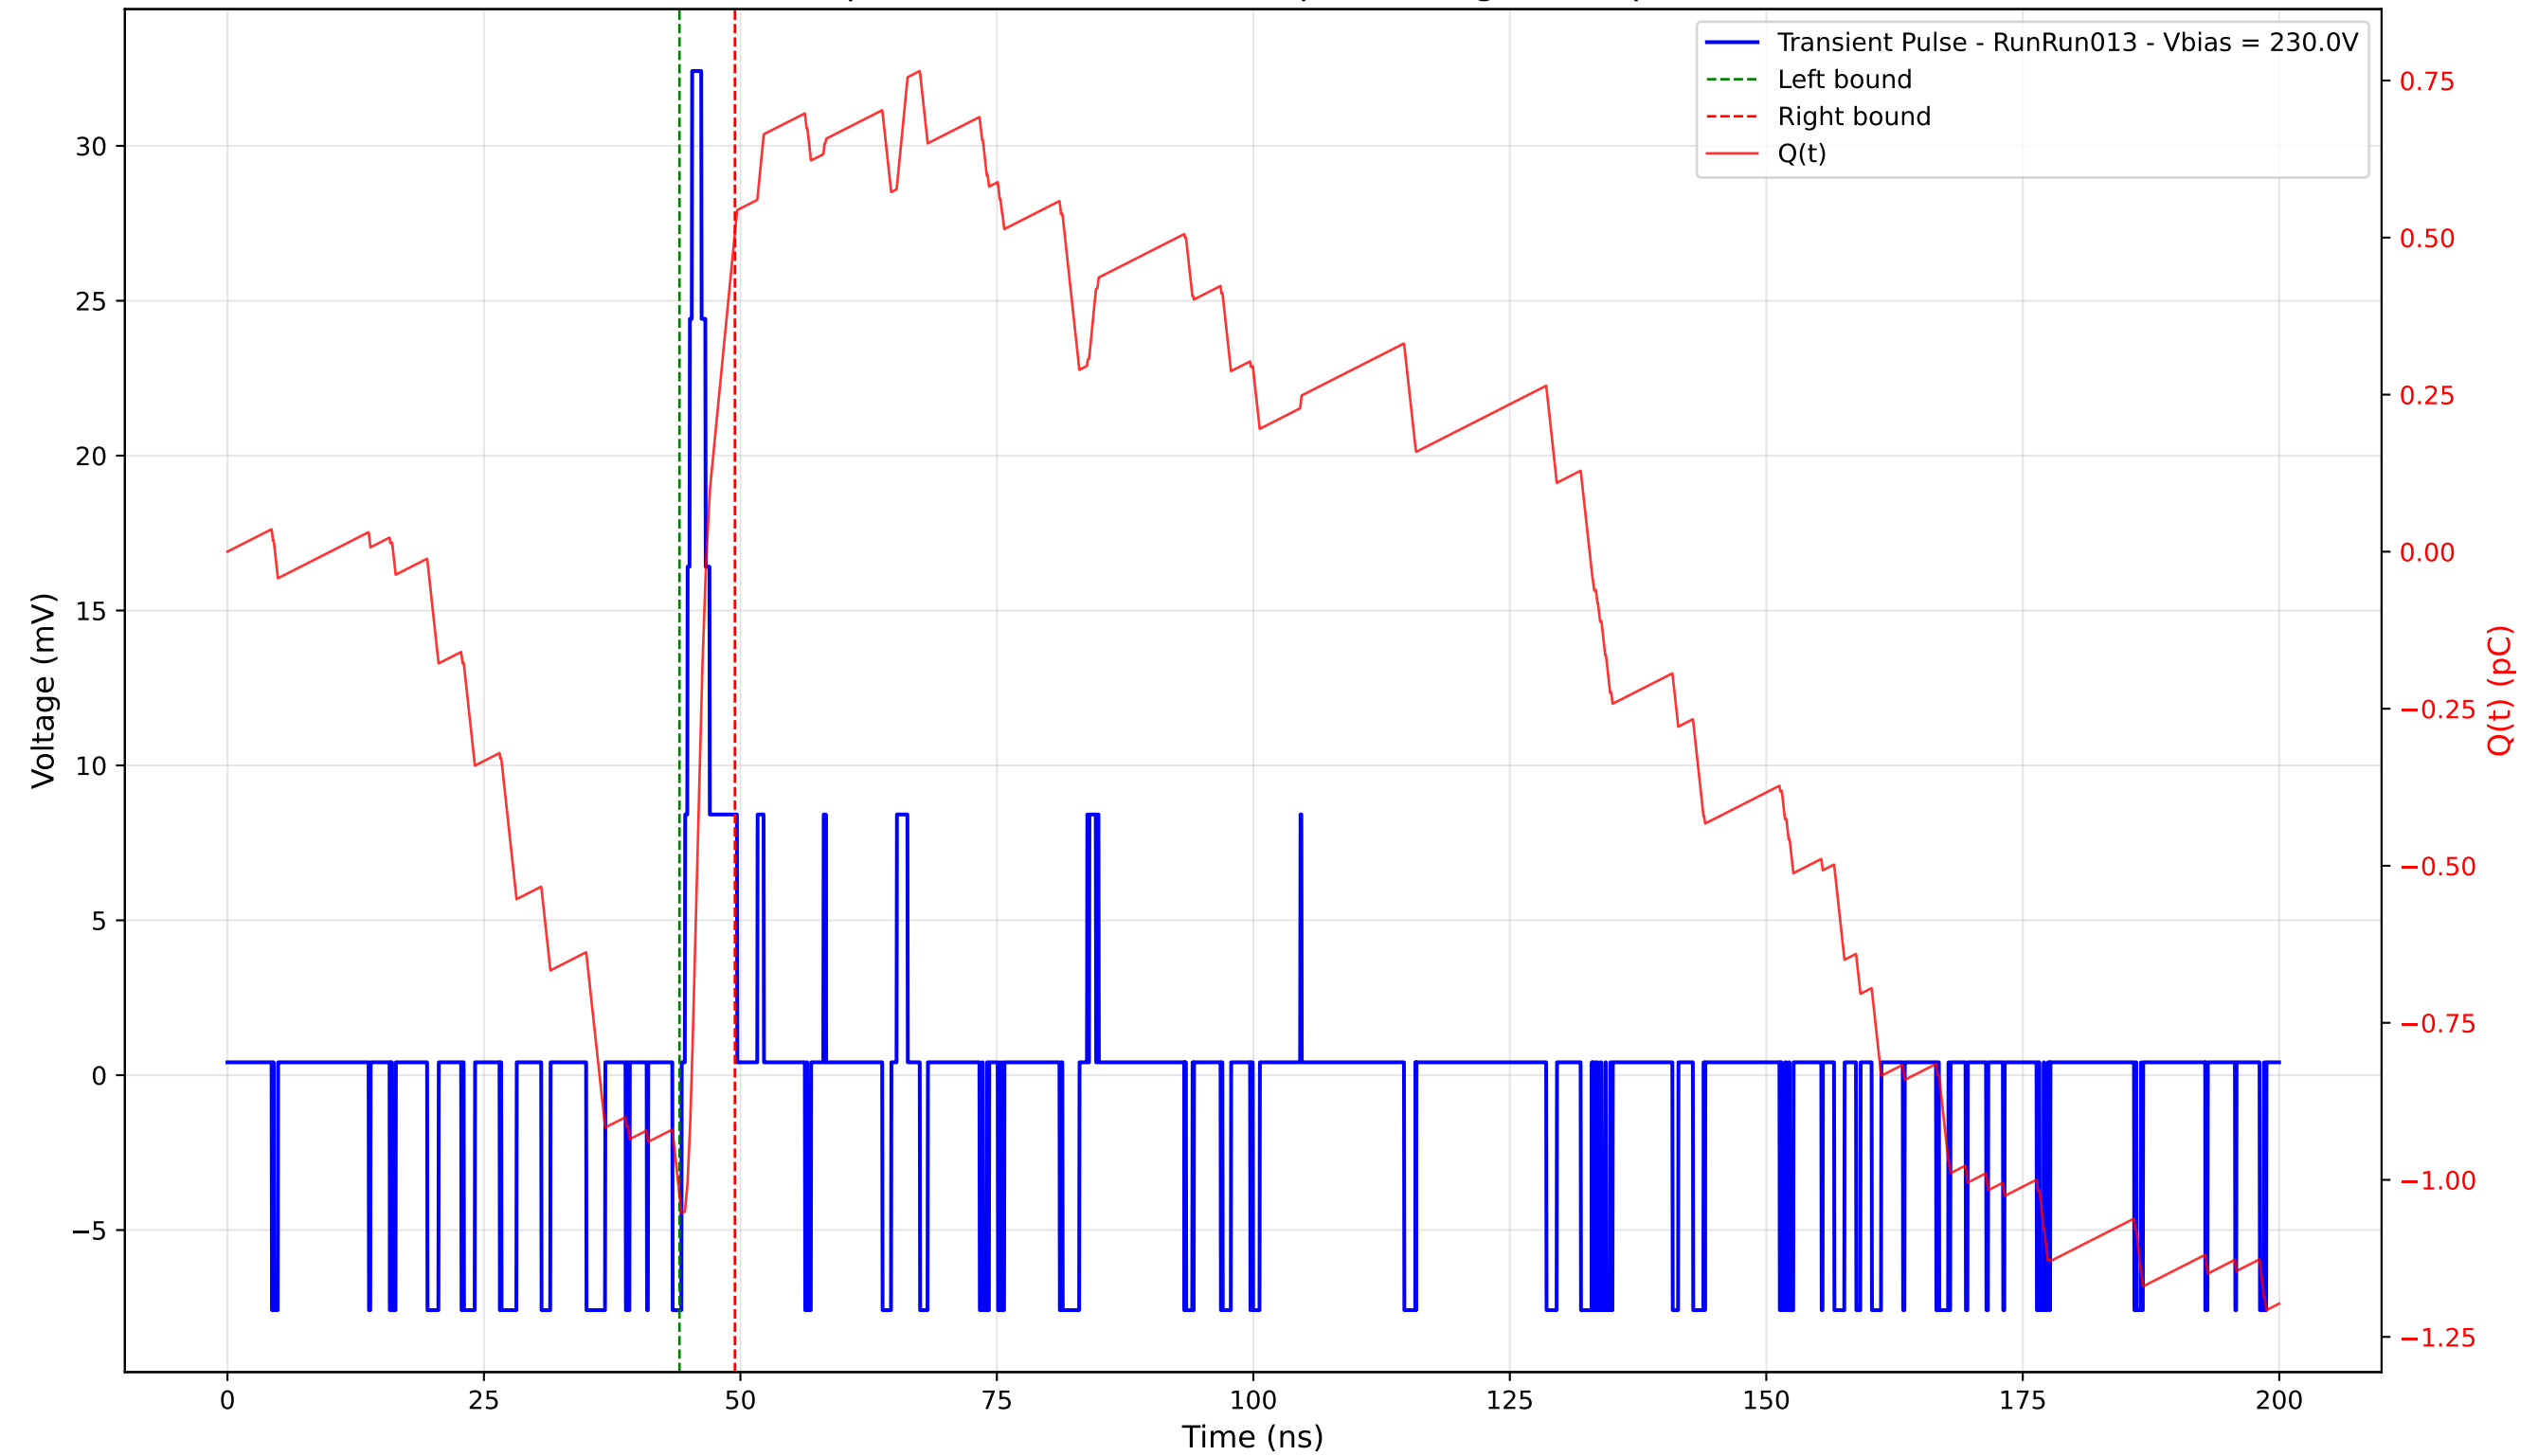


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.27 pC - Rise Time: 0.88 ns

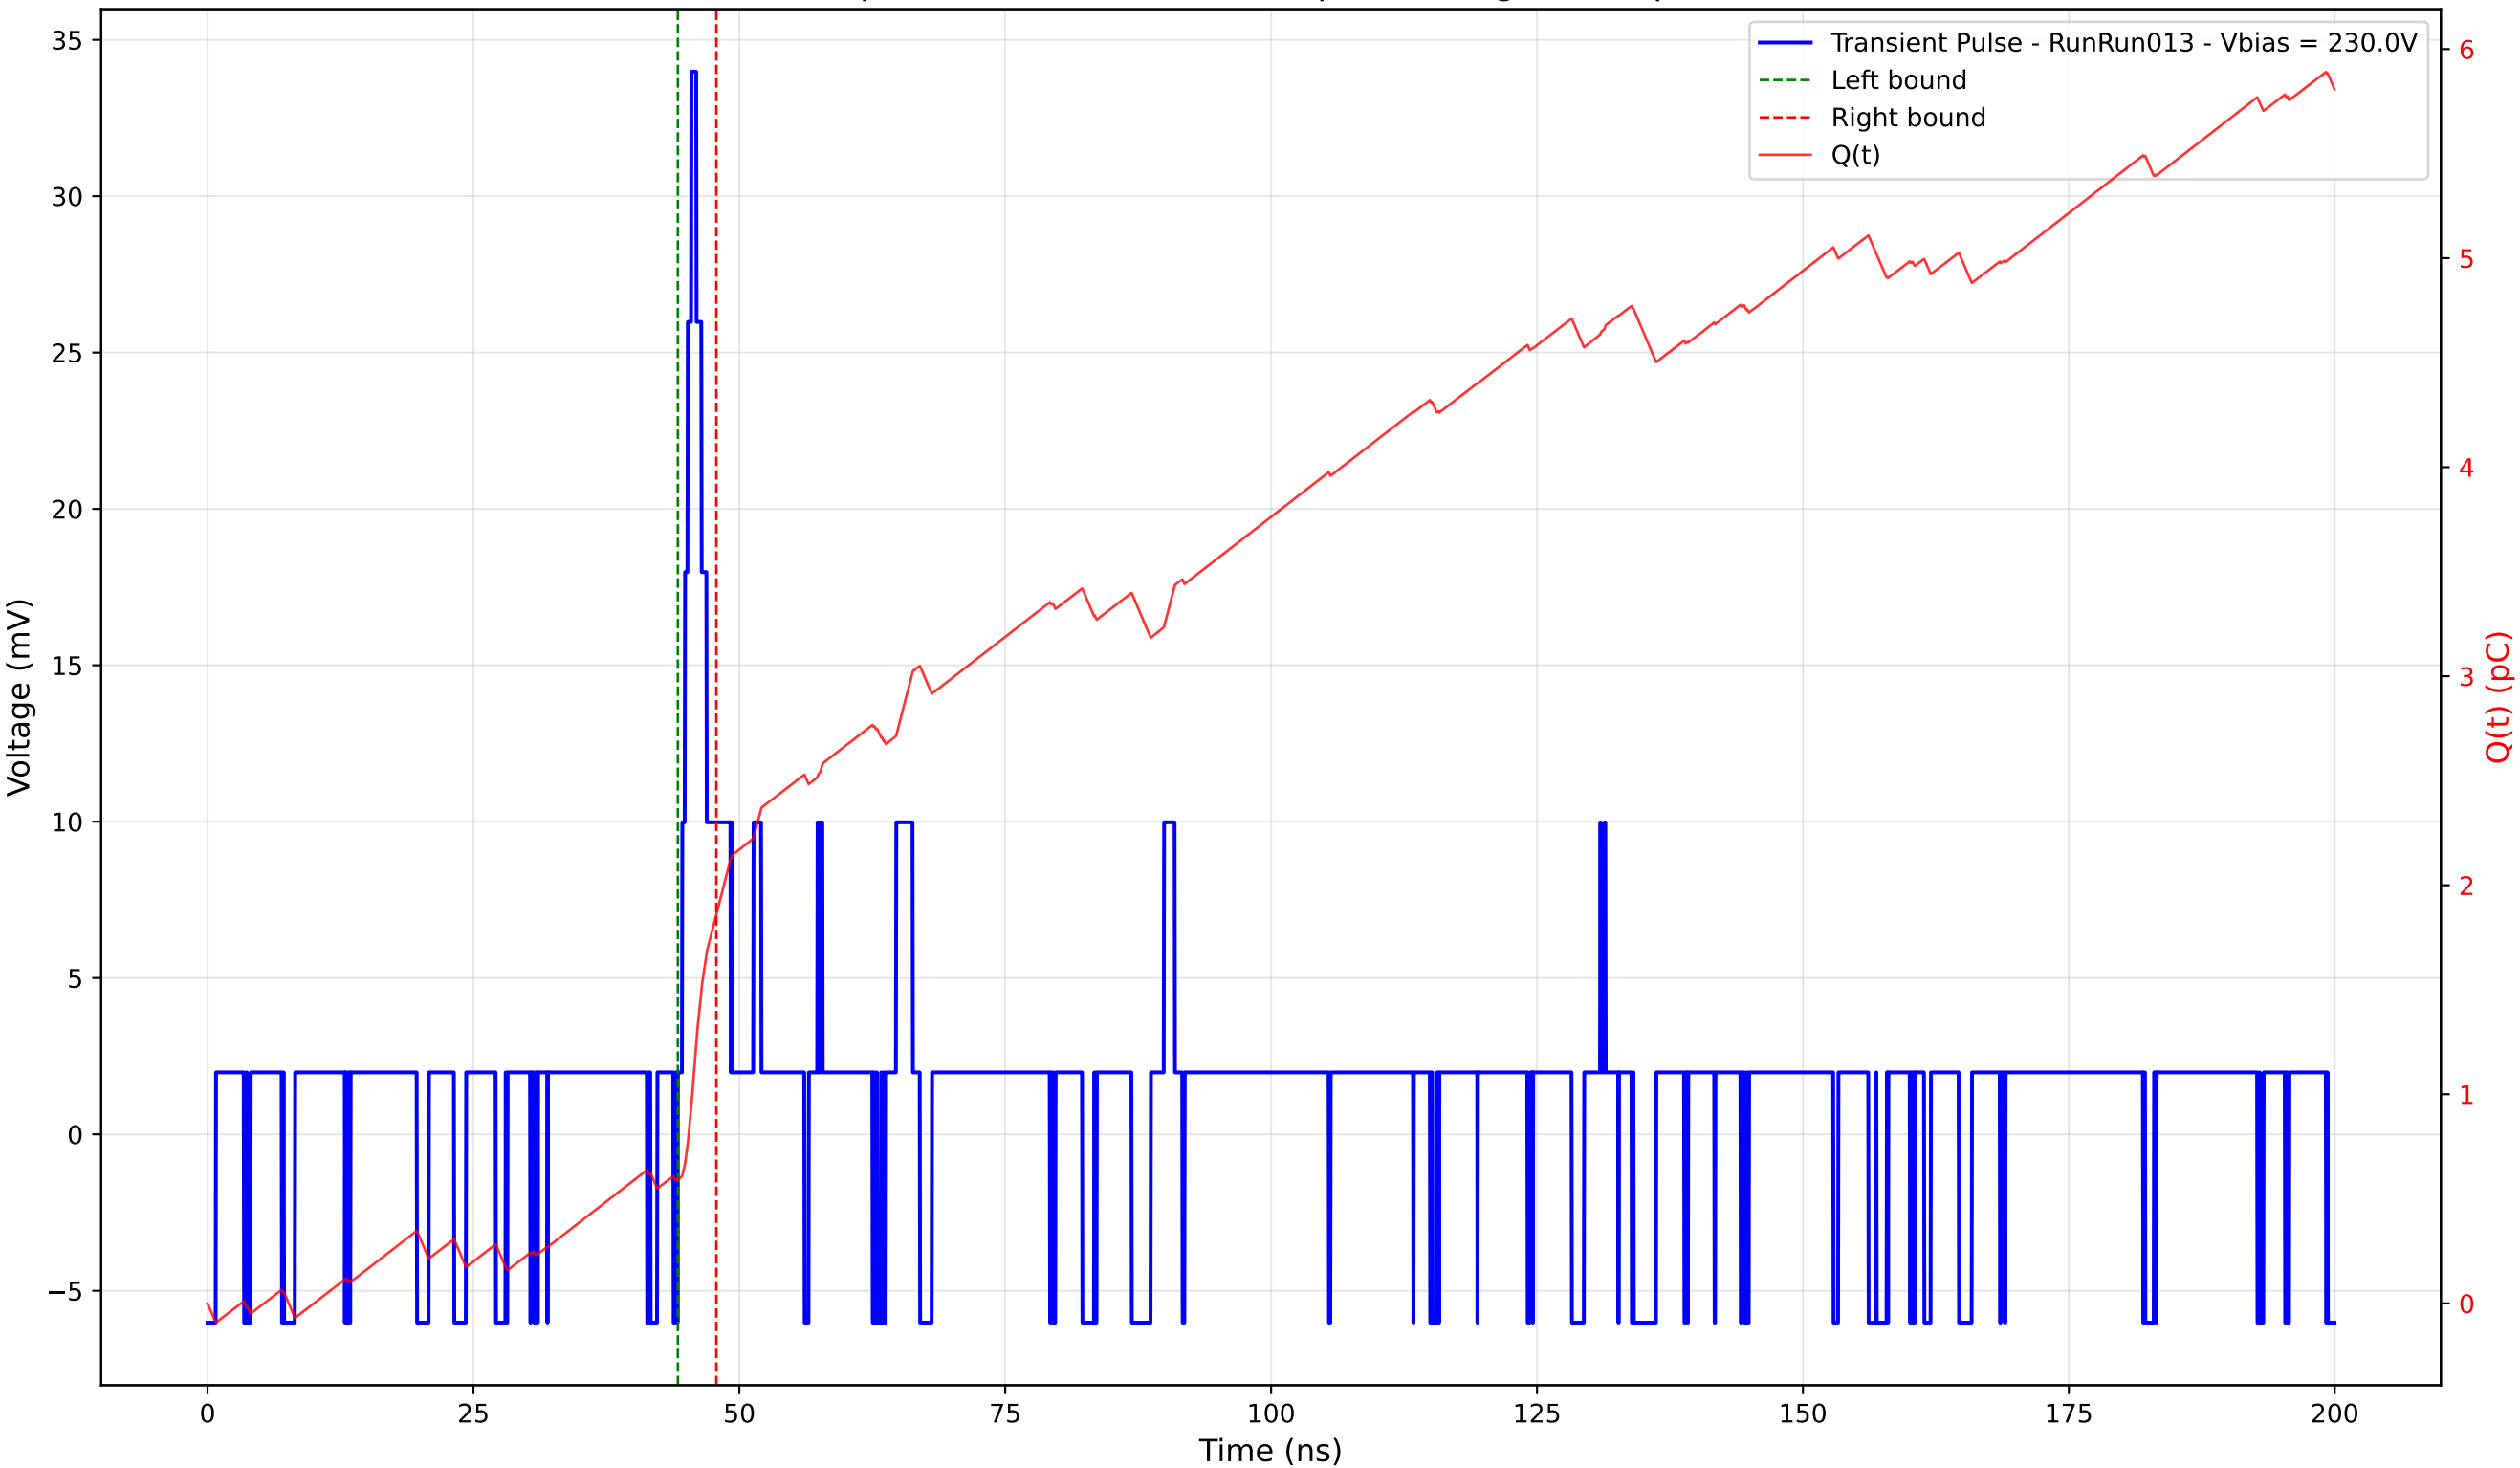


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.41 pC - Rise Time: 0.96 ns

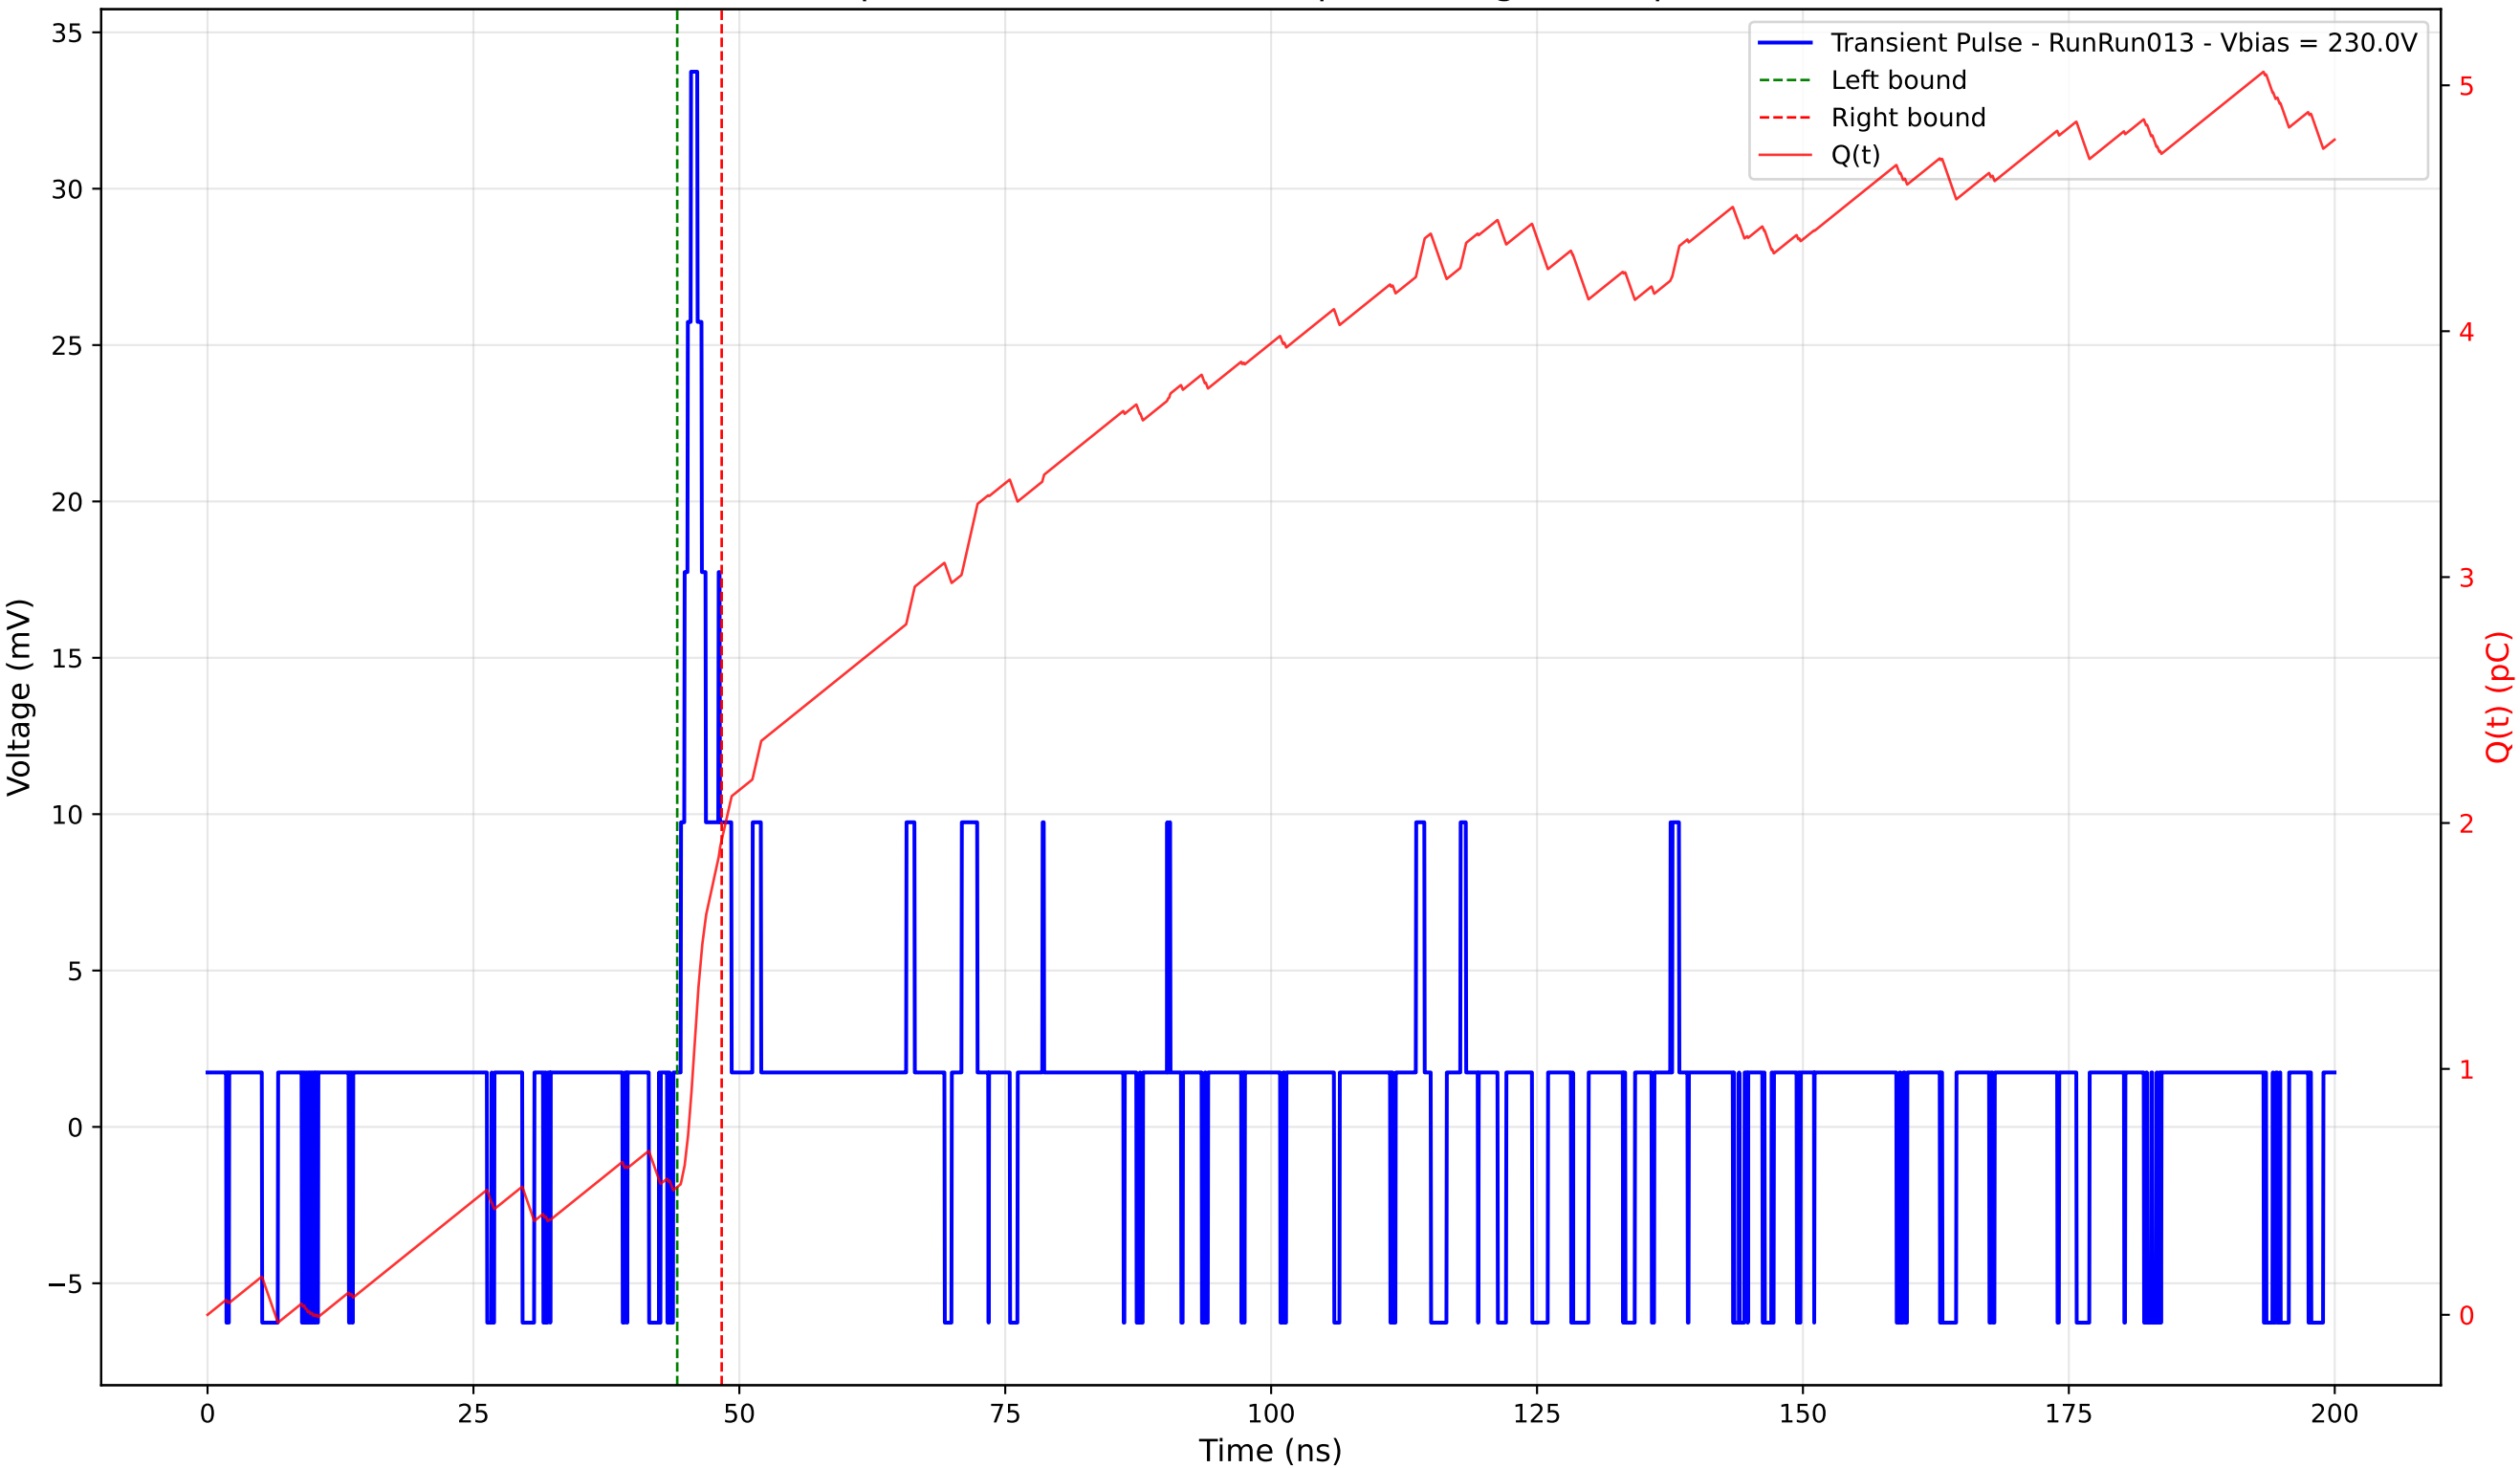


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.79 pC - Rise Time: 0.92 ns

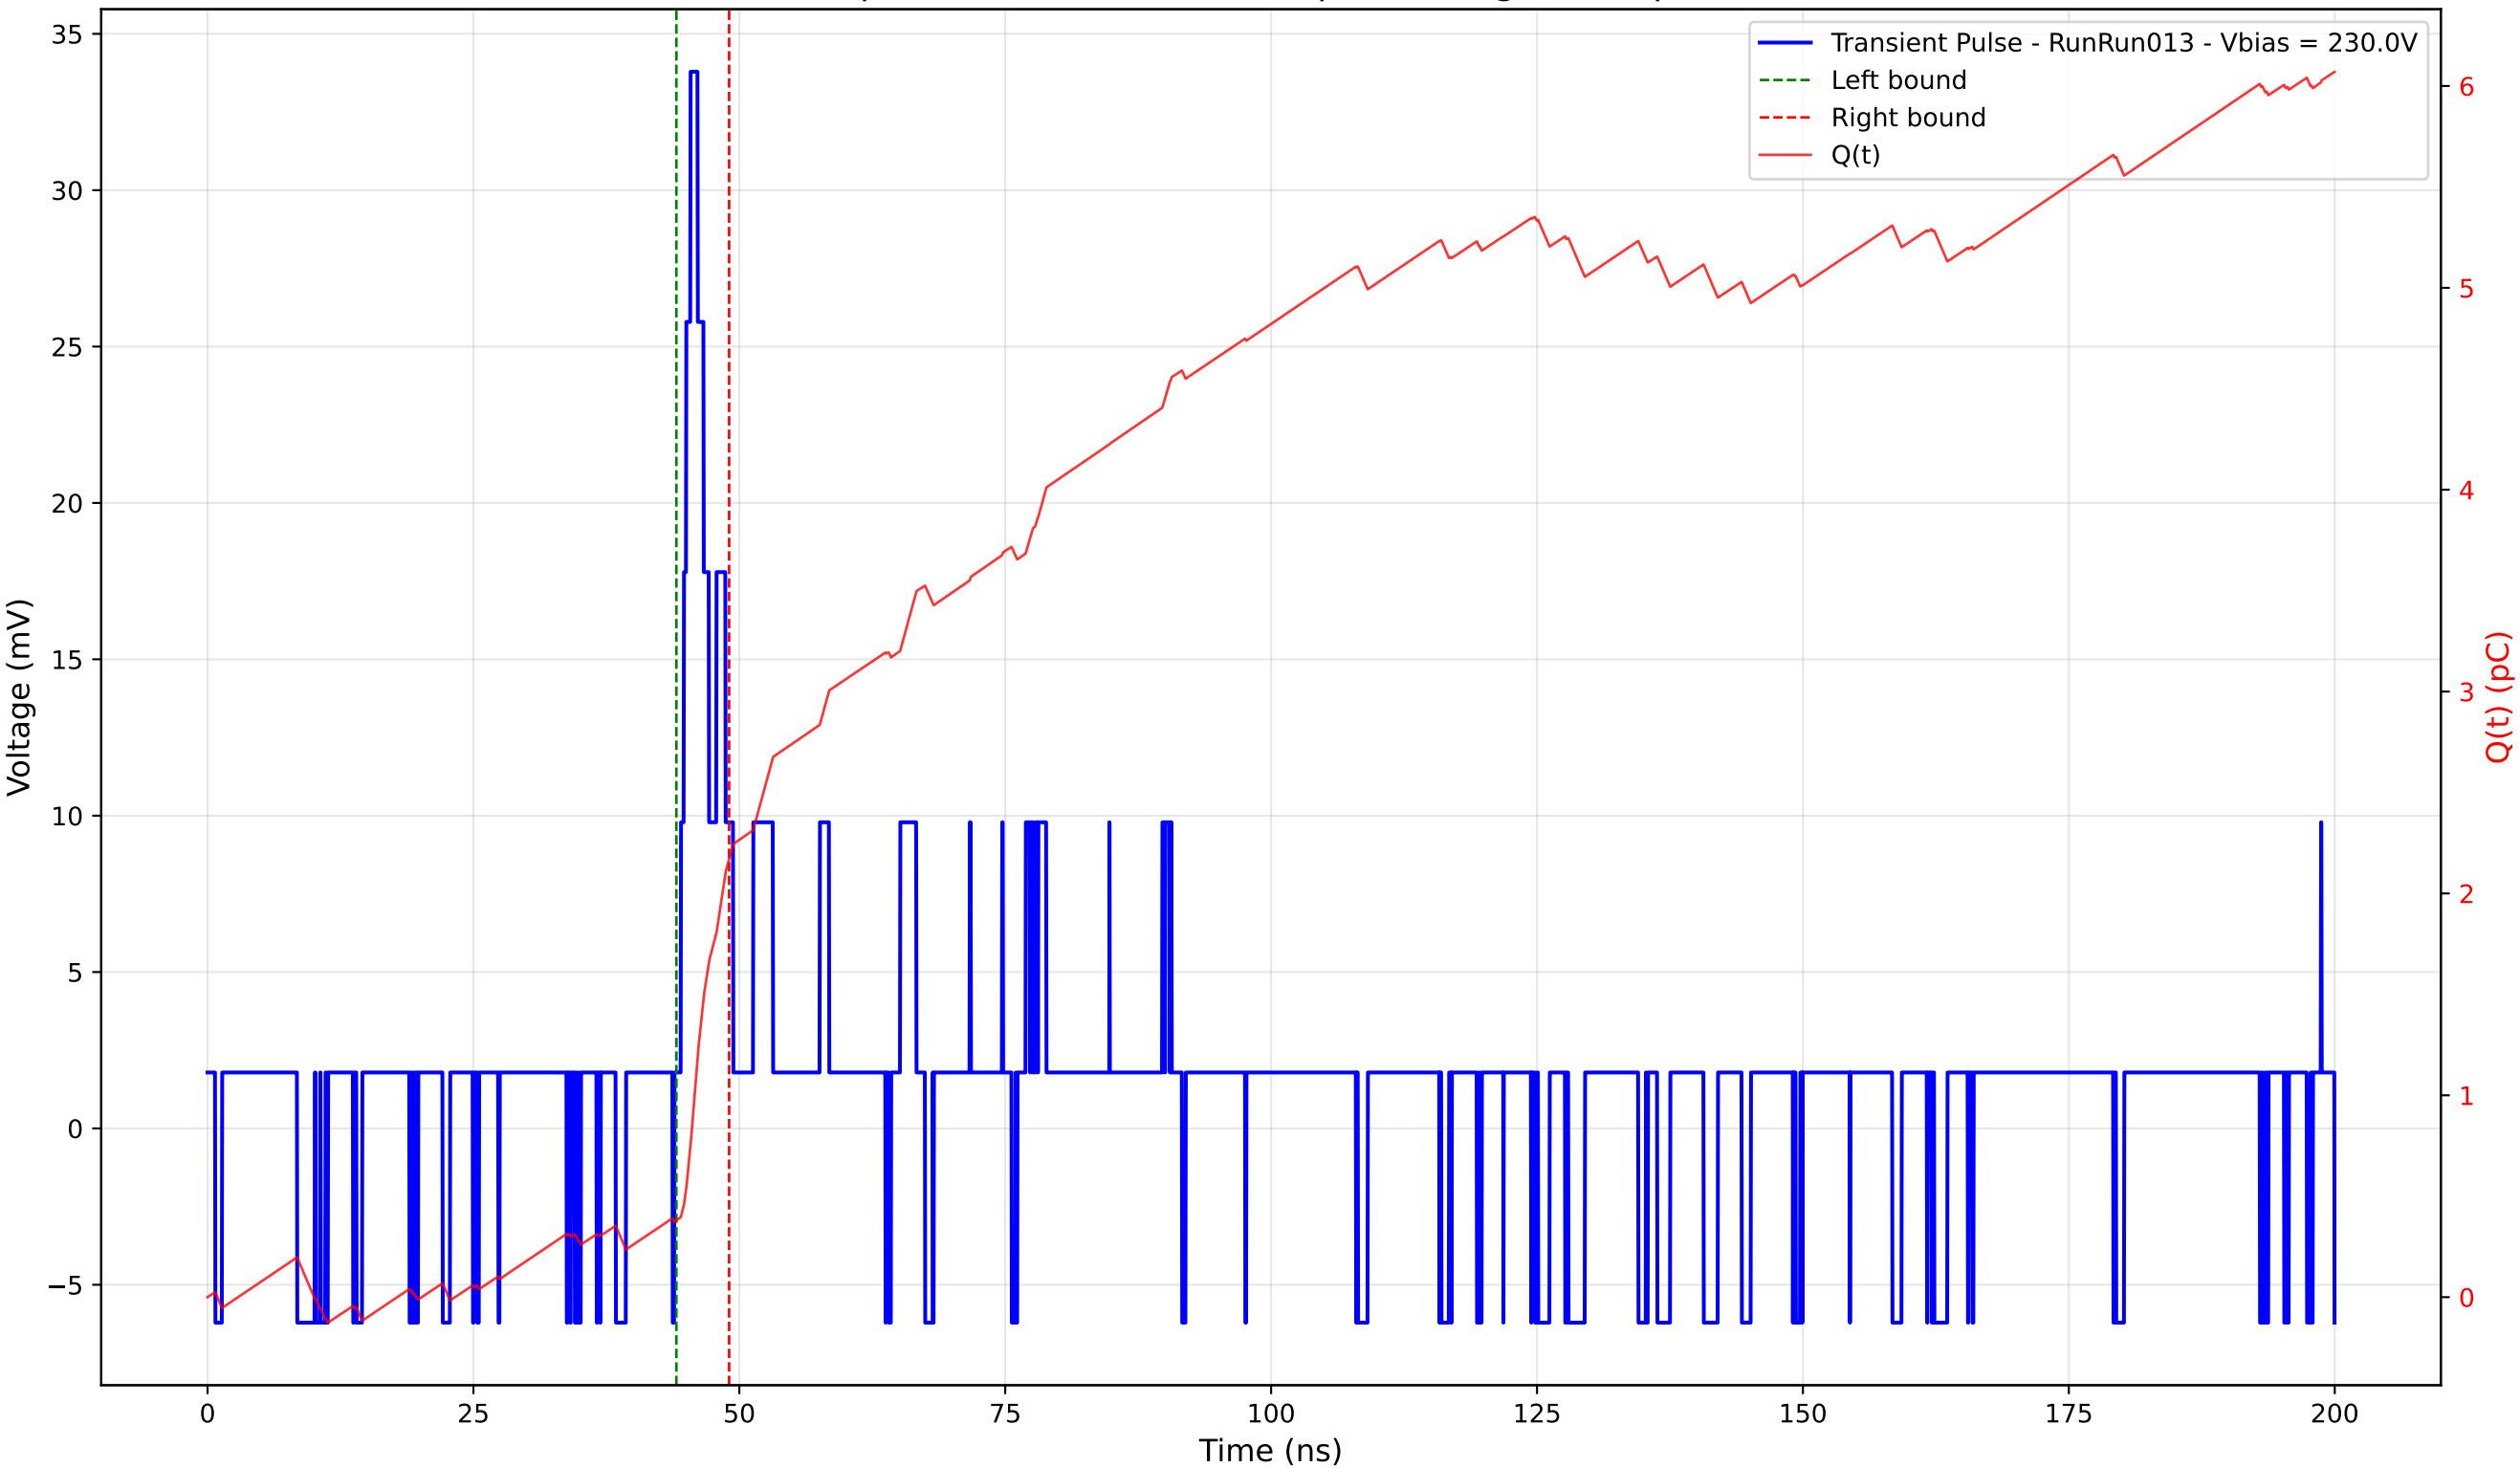


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.50 pC - Rise Time: 0.89 ns

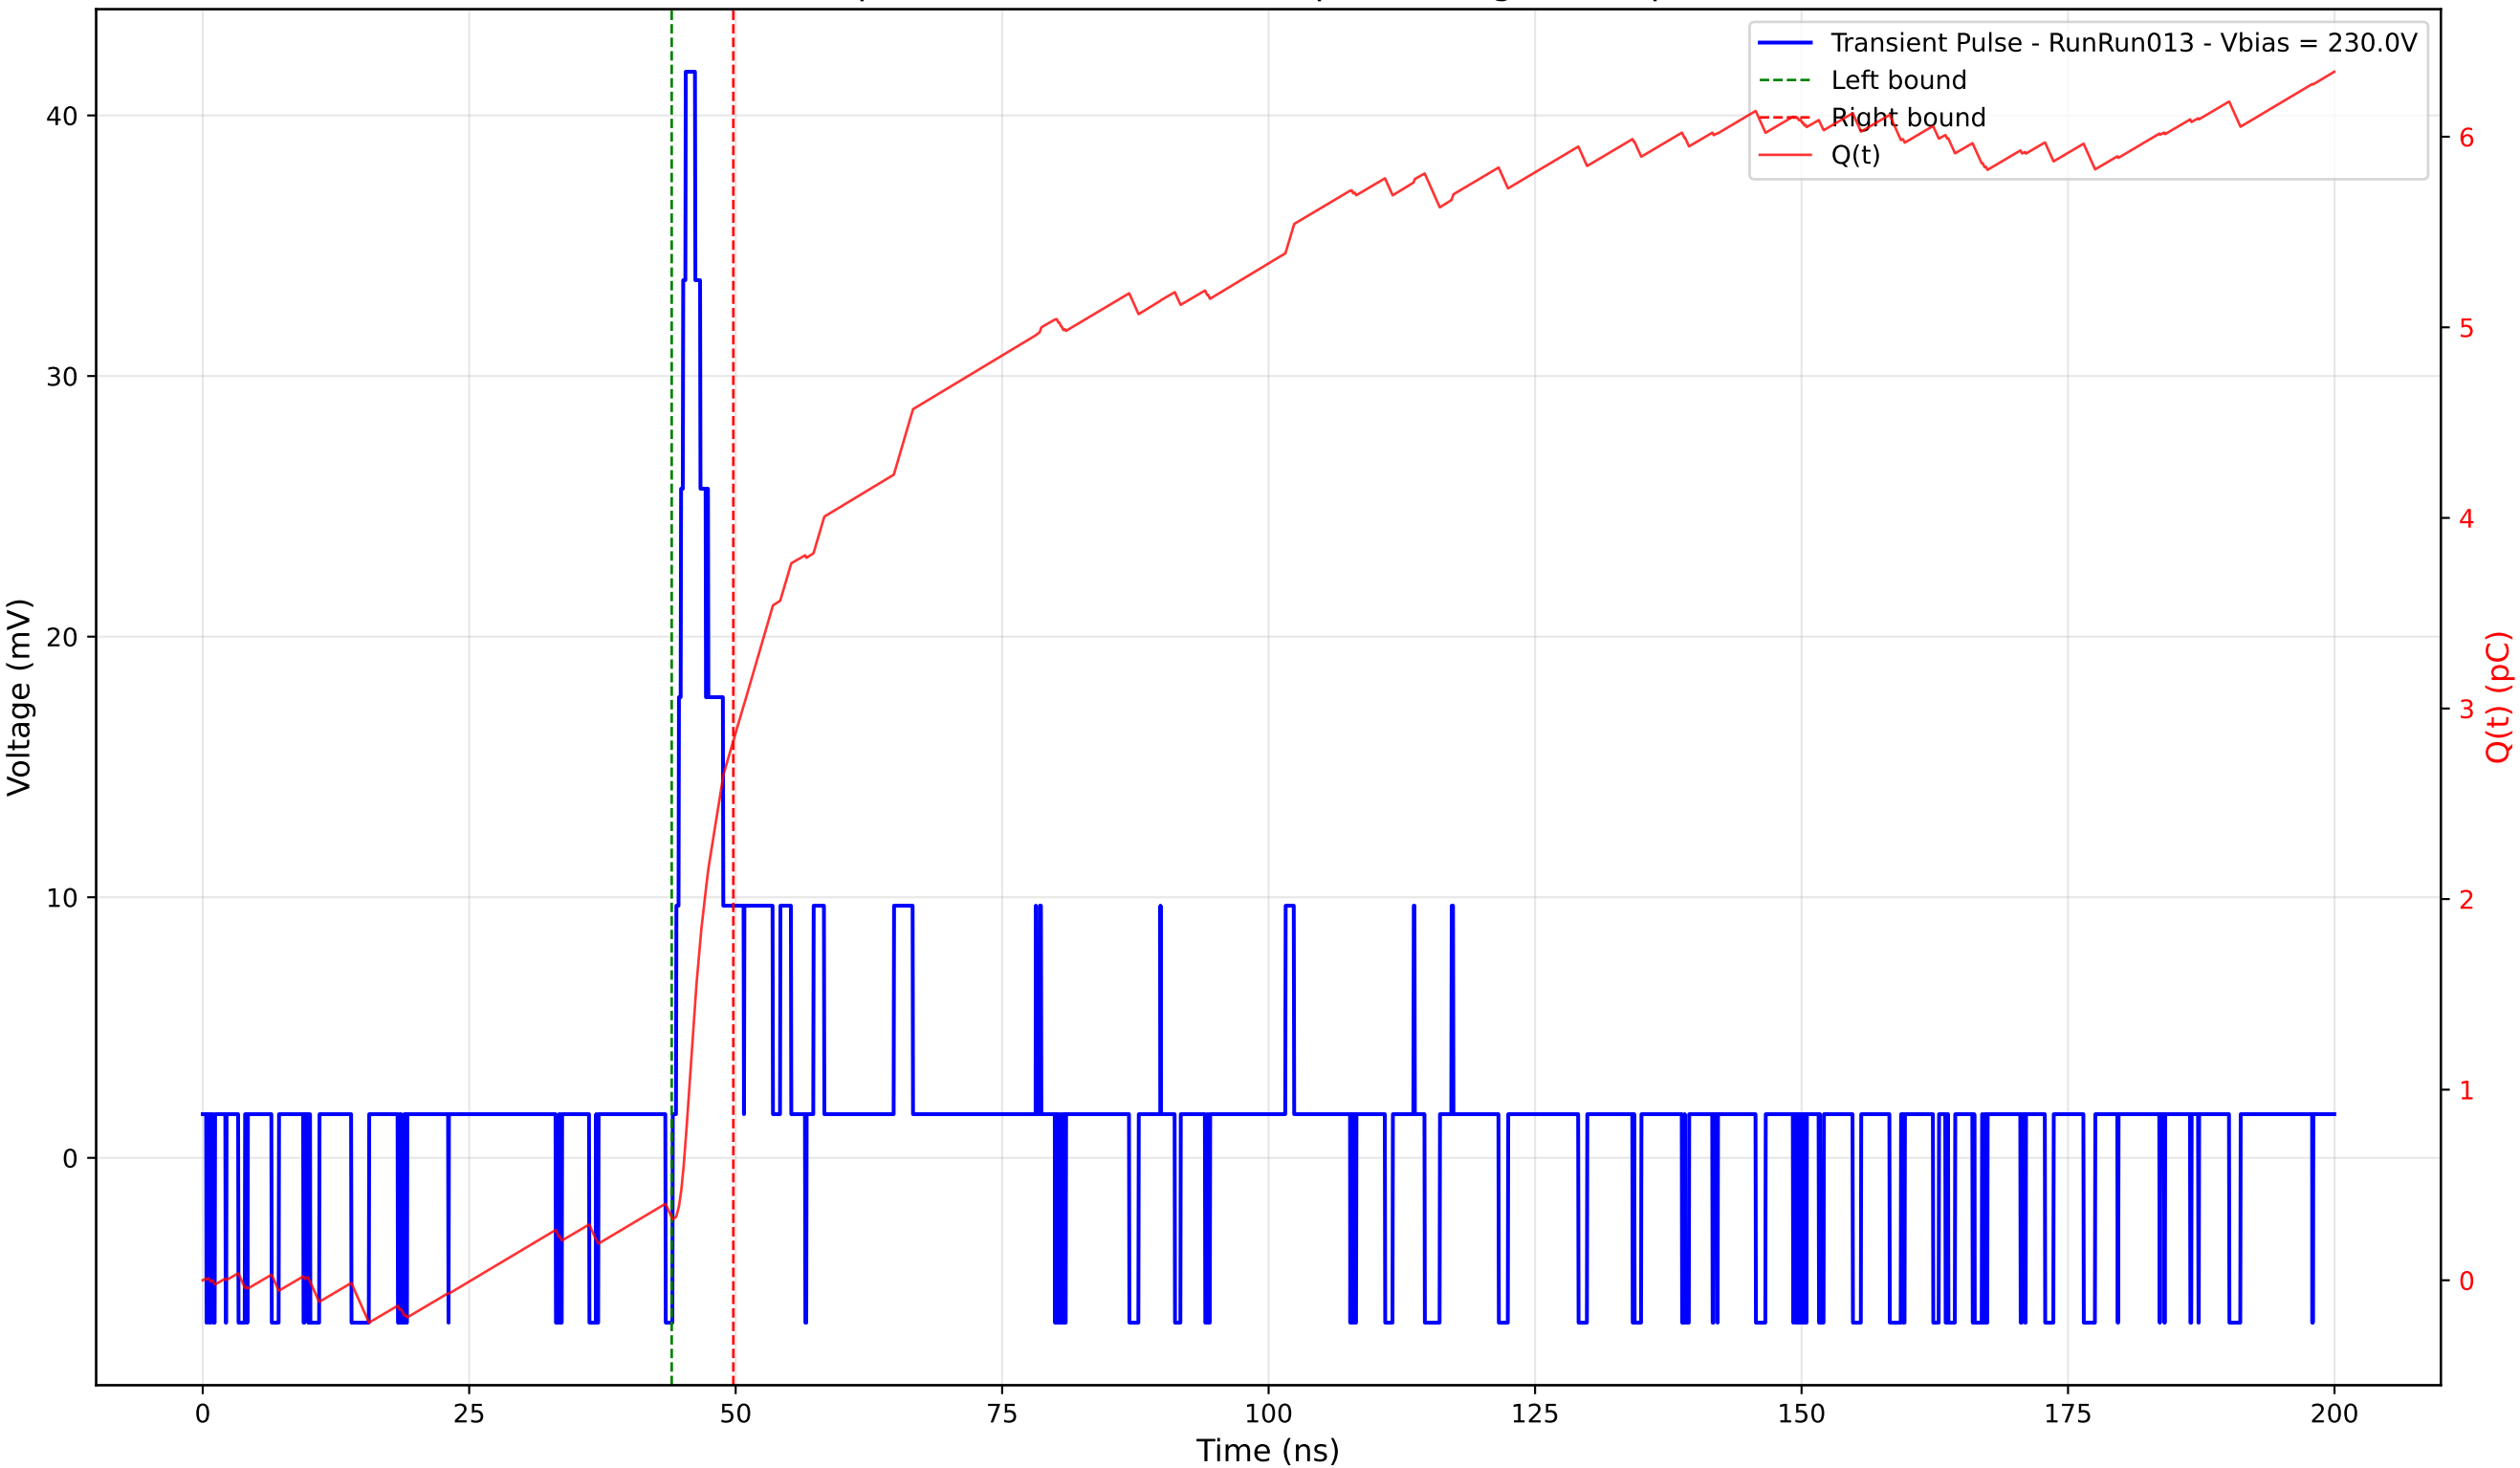


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.71 pC - Rise Time: 0.99 ns

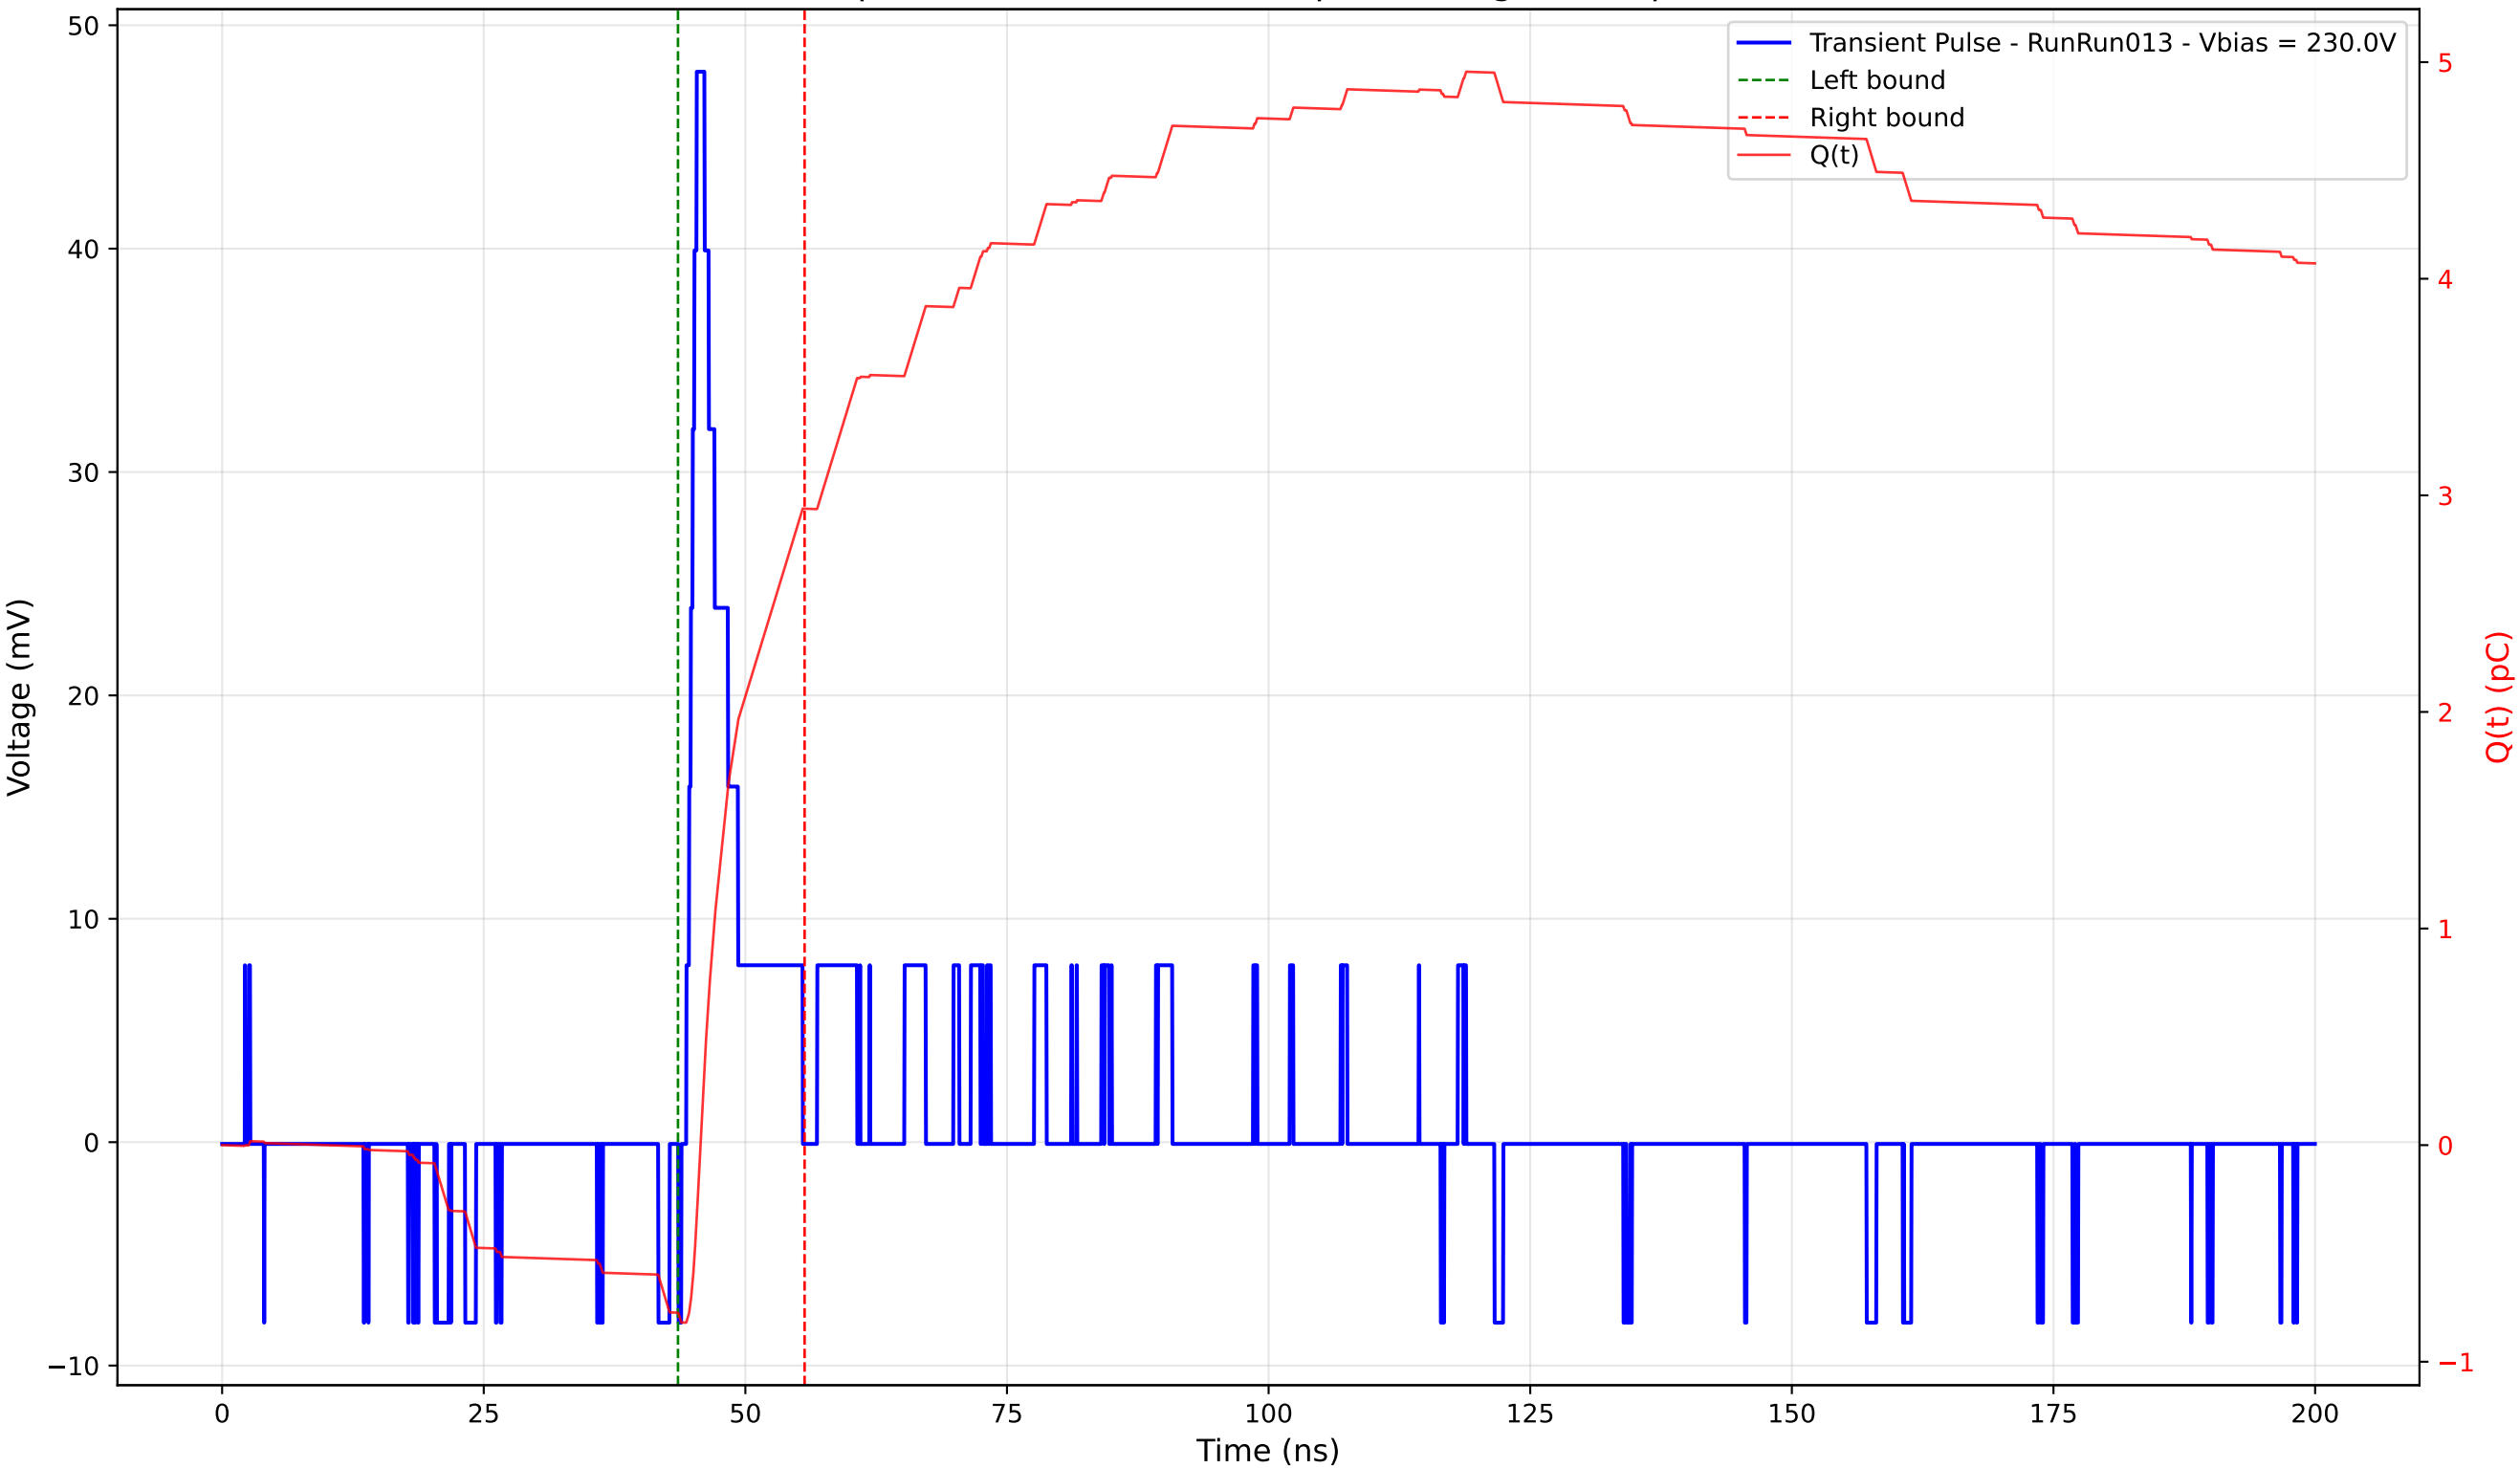


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 3.84 pC - Rise Time: 0.97 ns

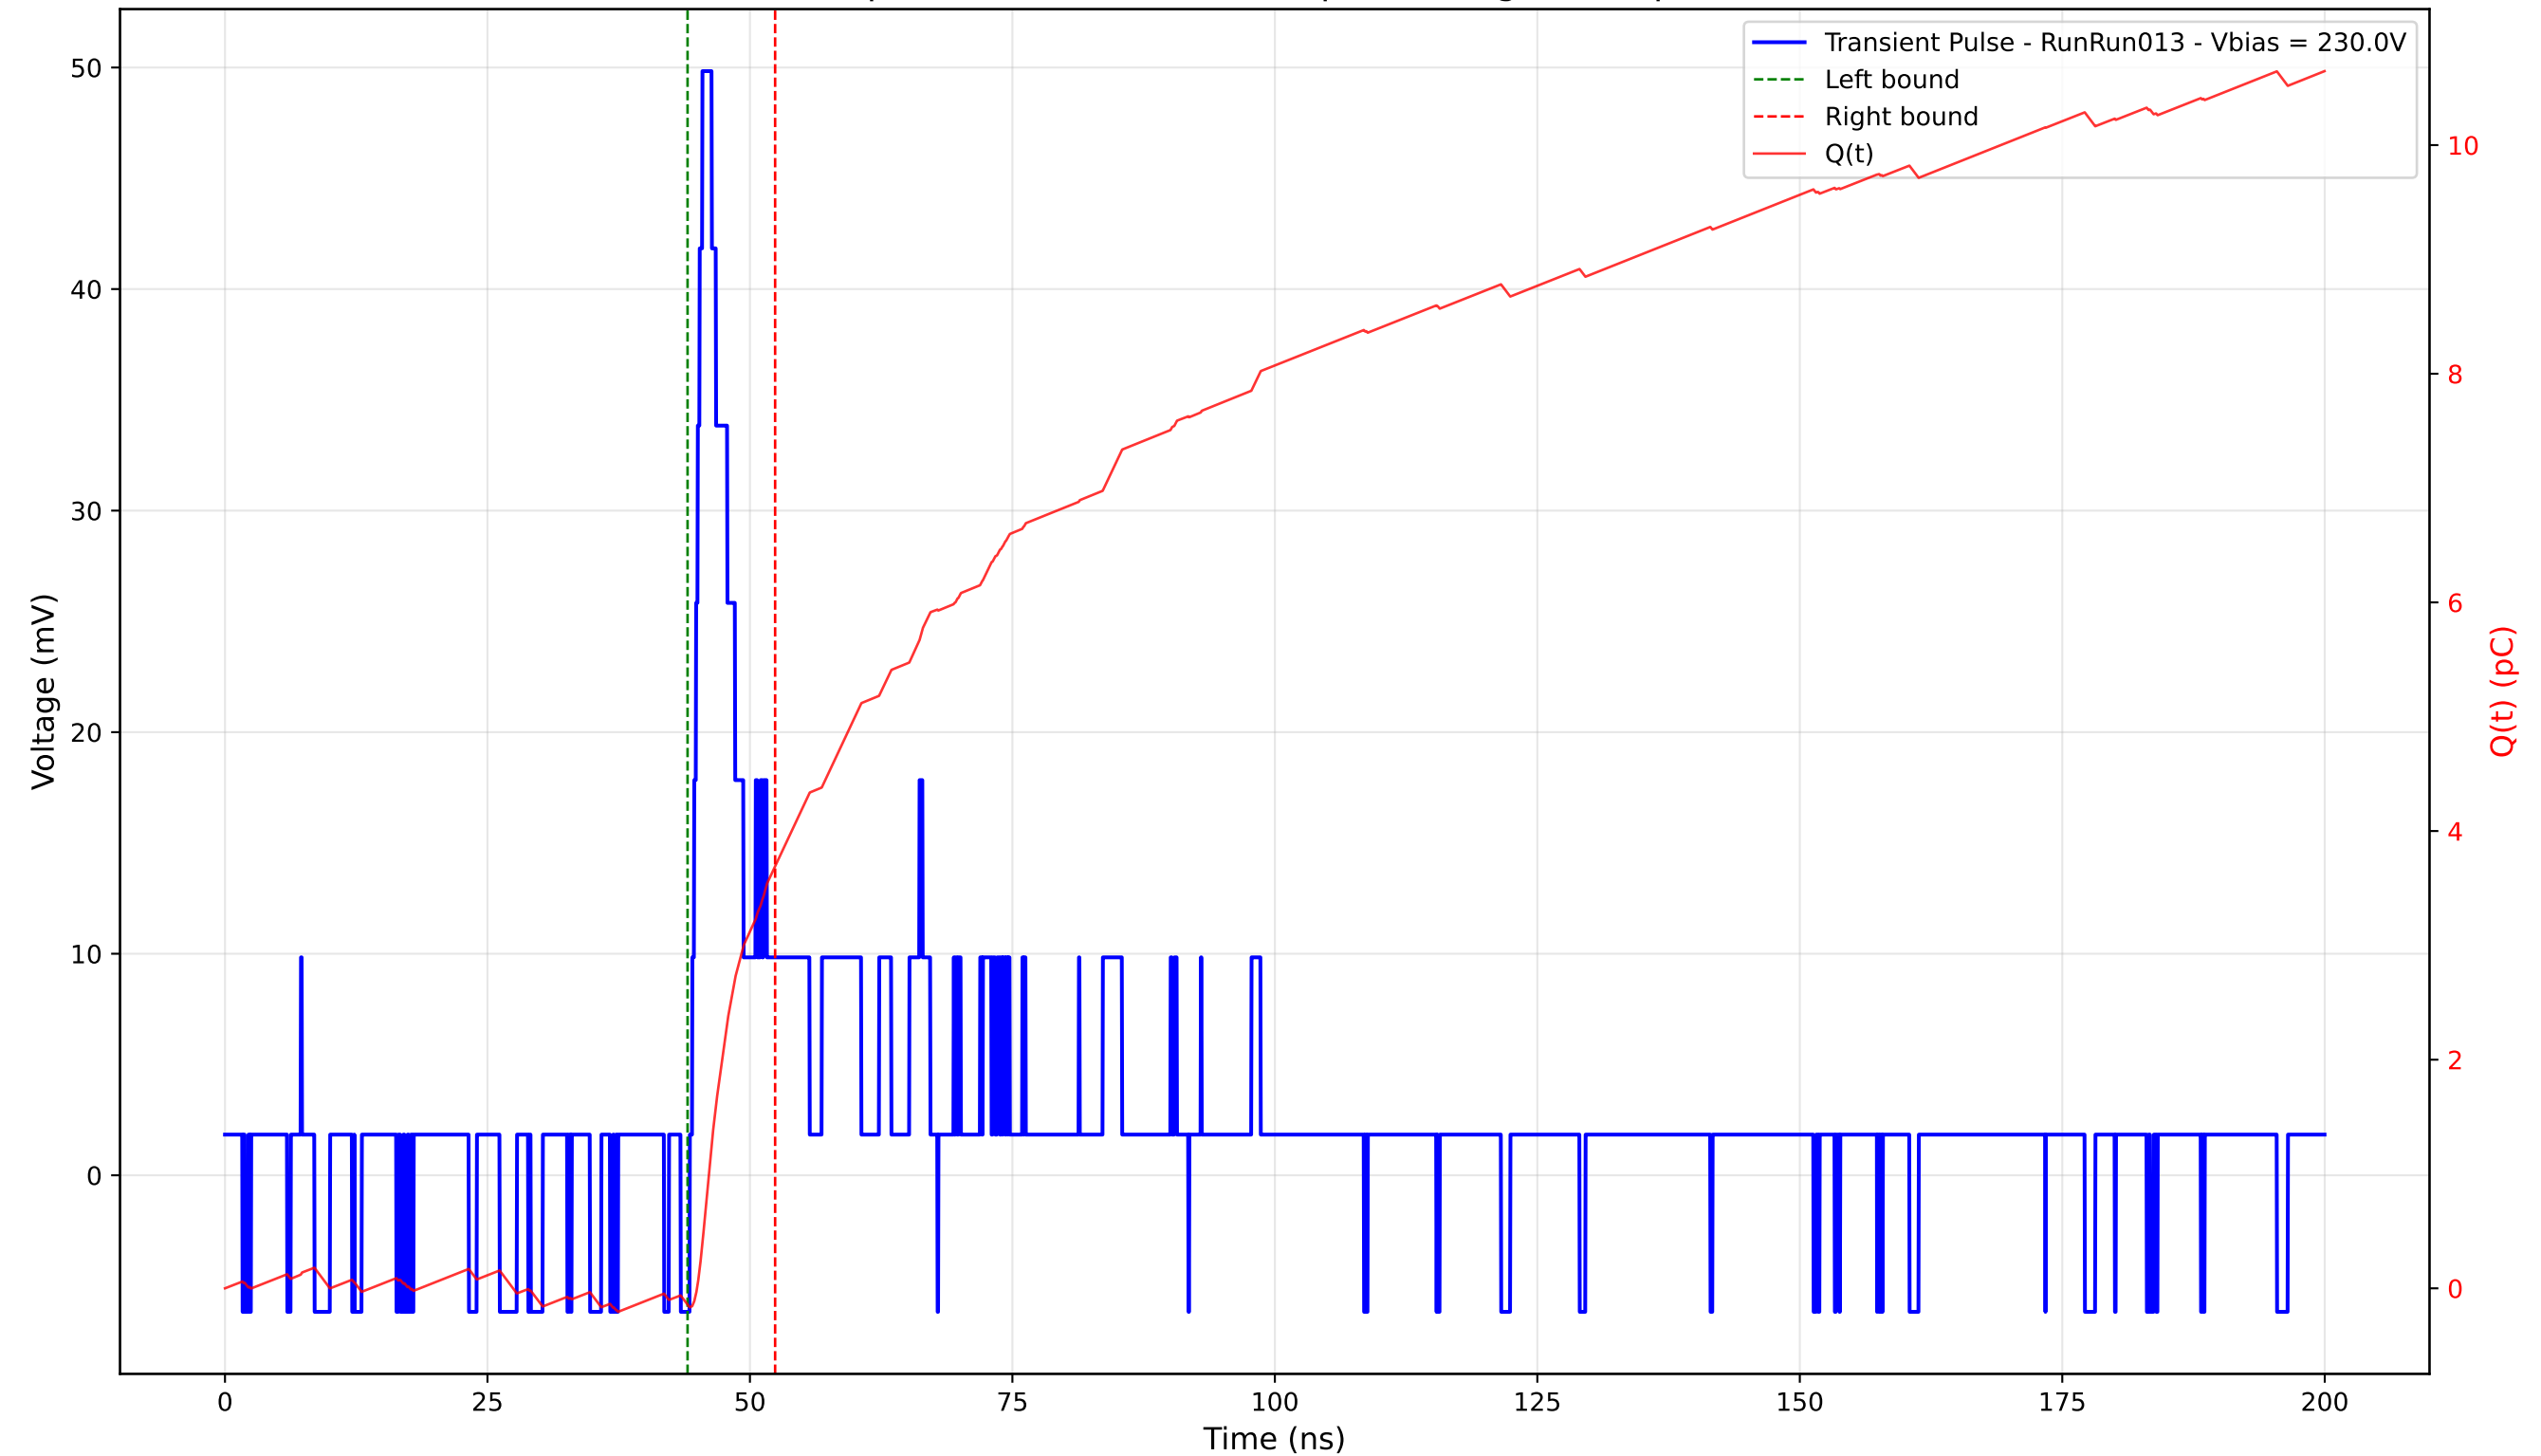


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 3.30 pC - Rise Time: 0.69 ns

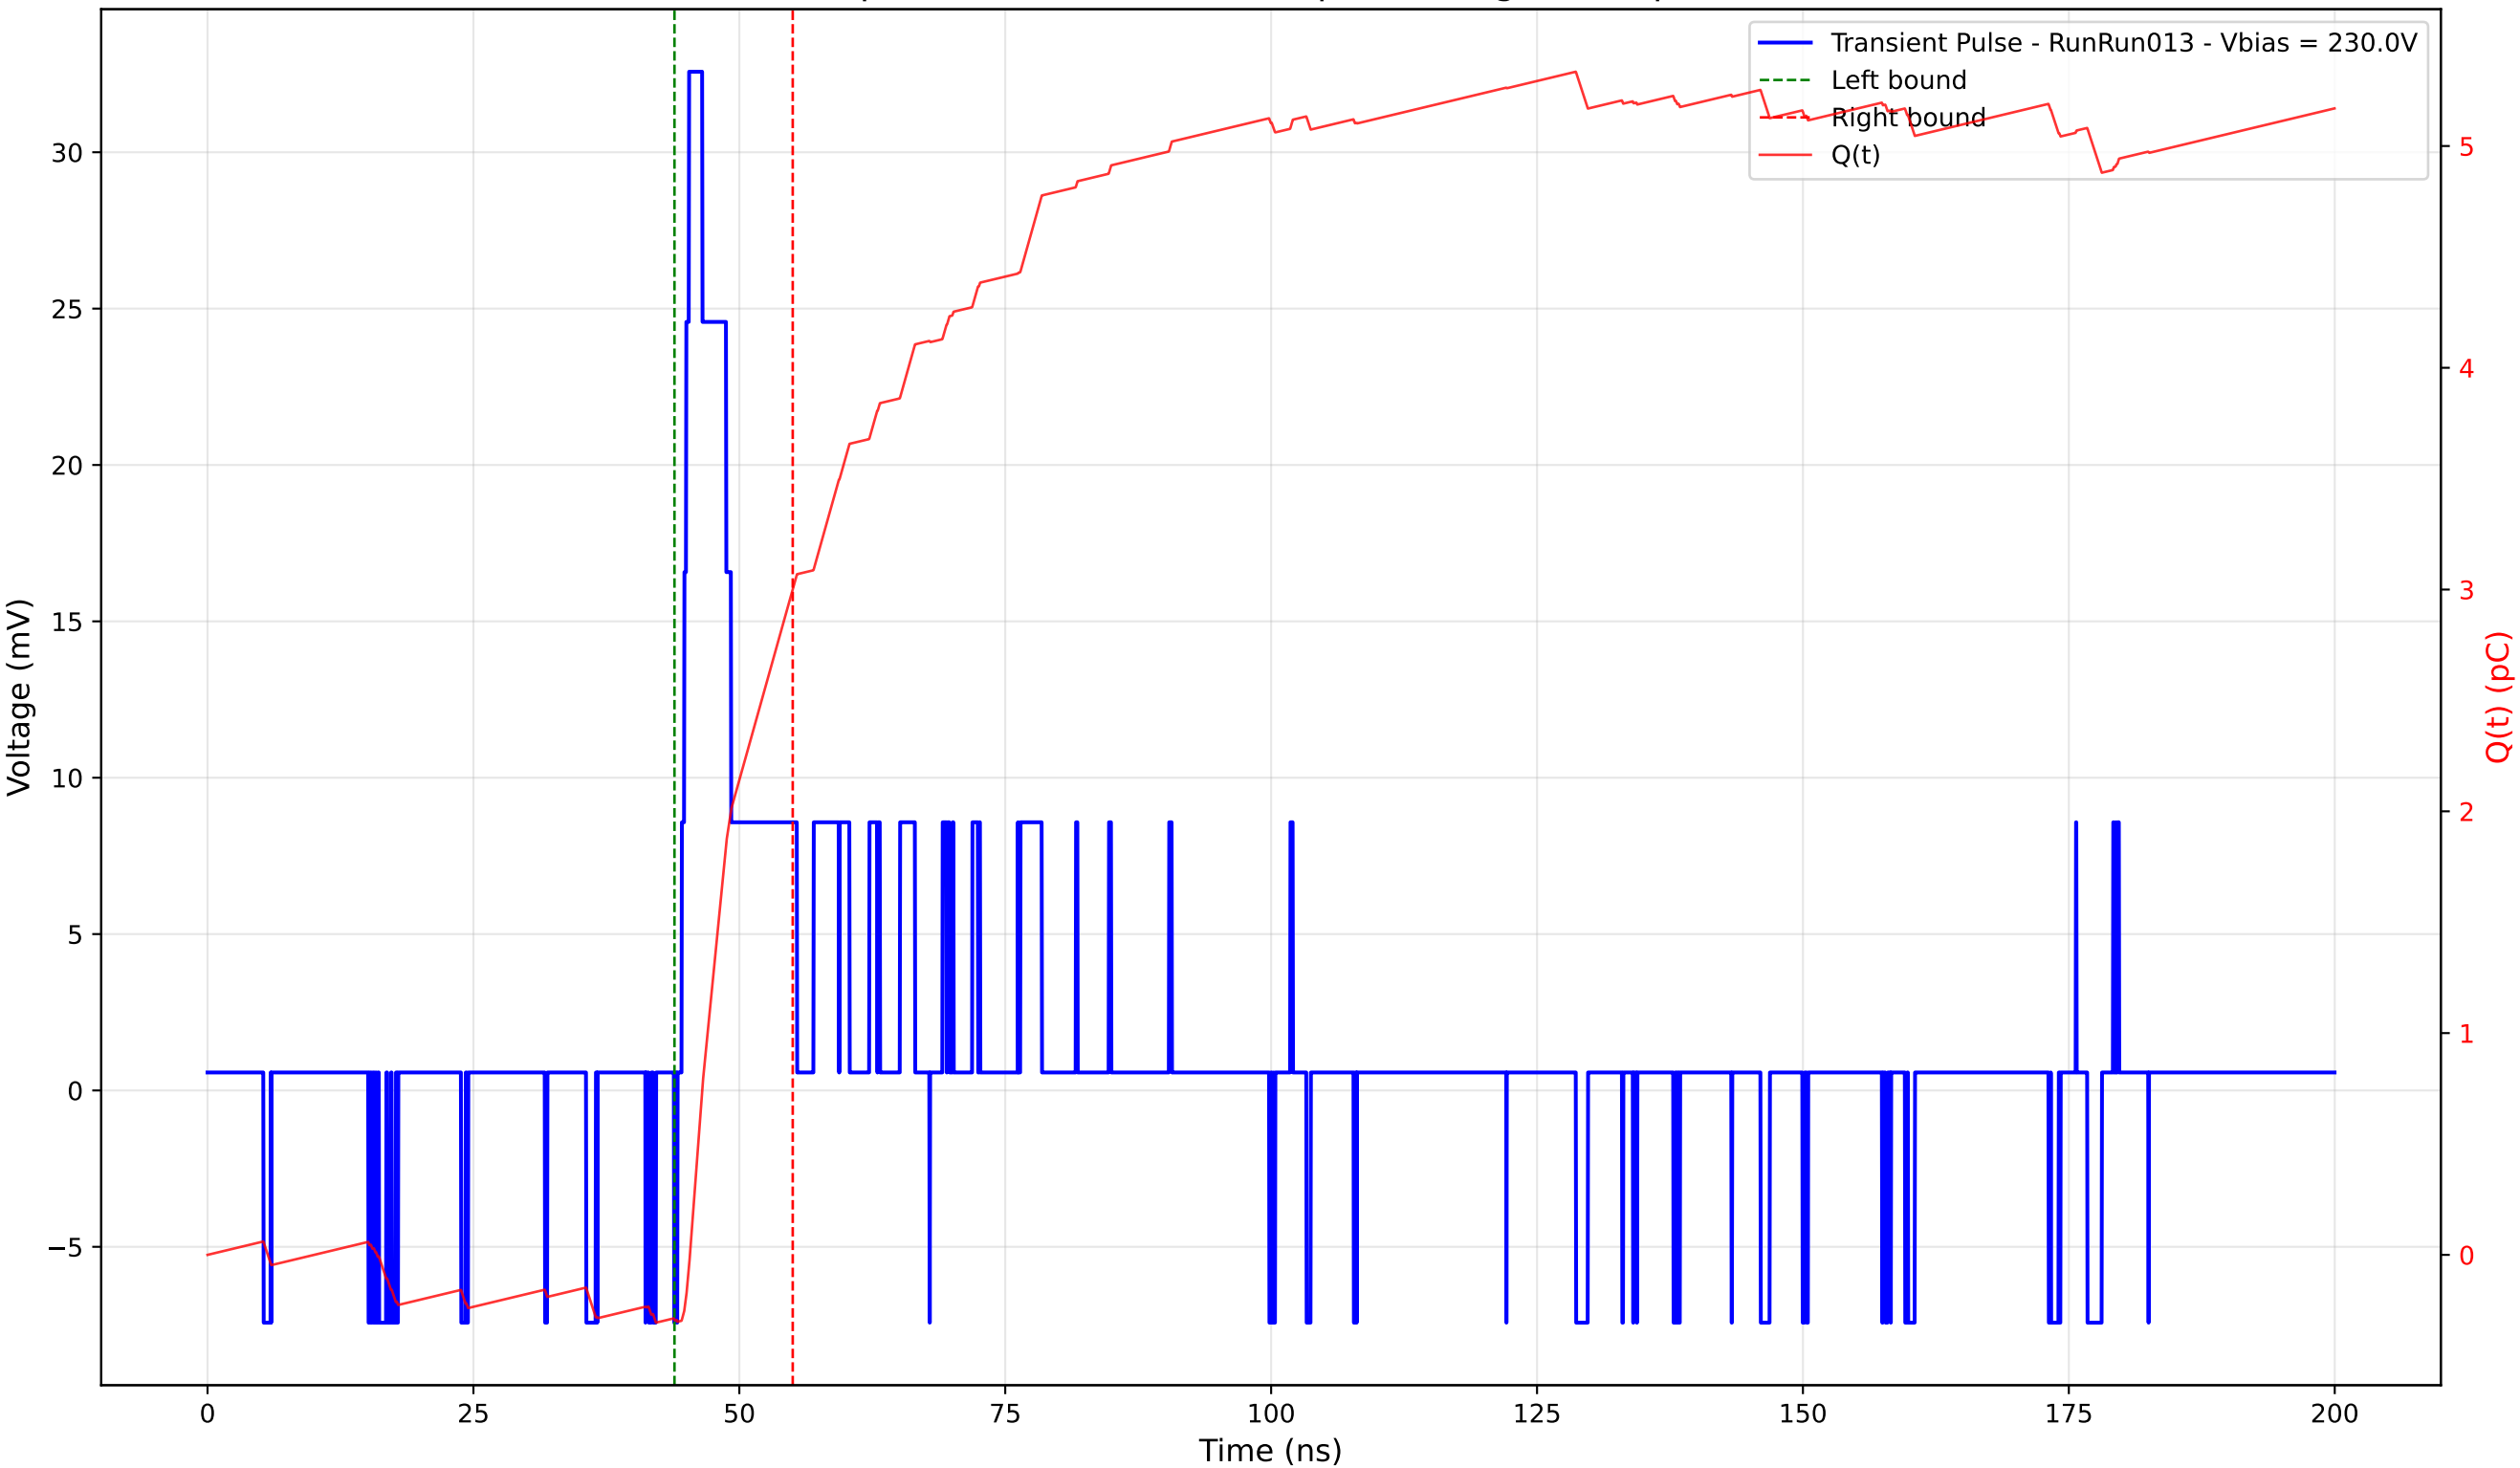


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 1.30 pC - Rise Time: 0.76 ns

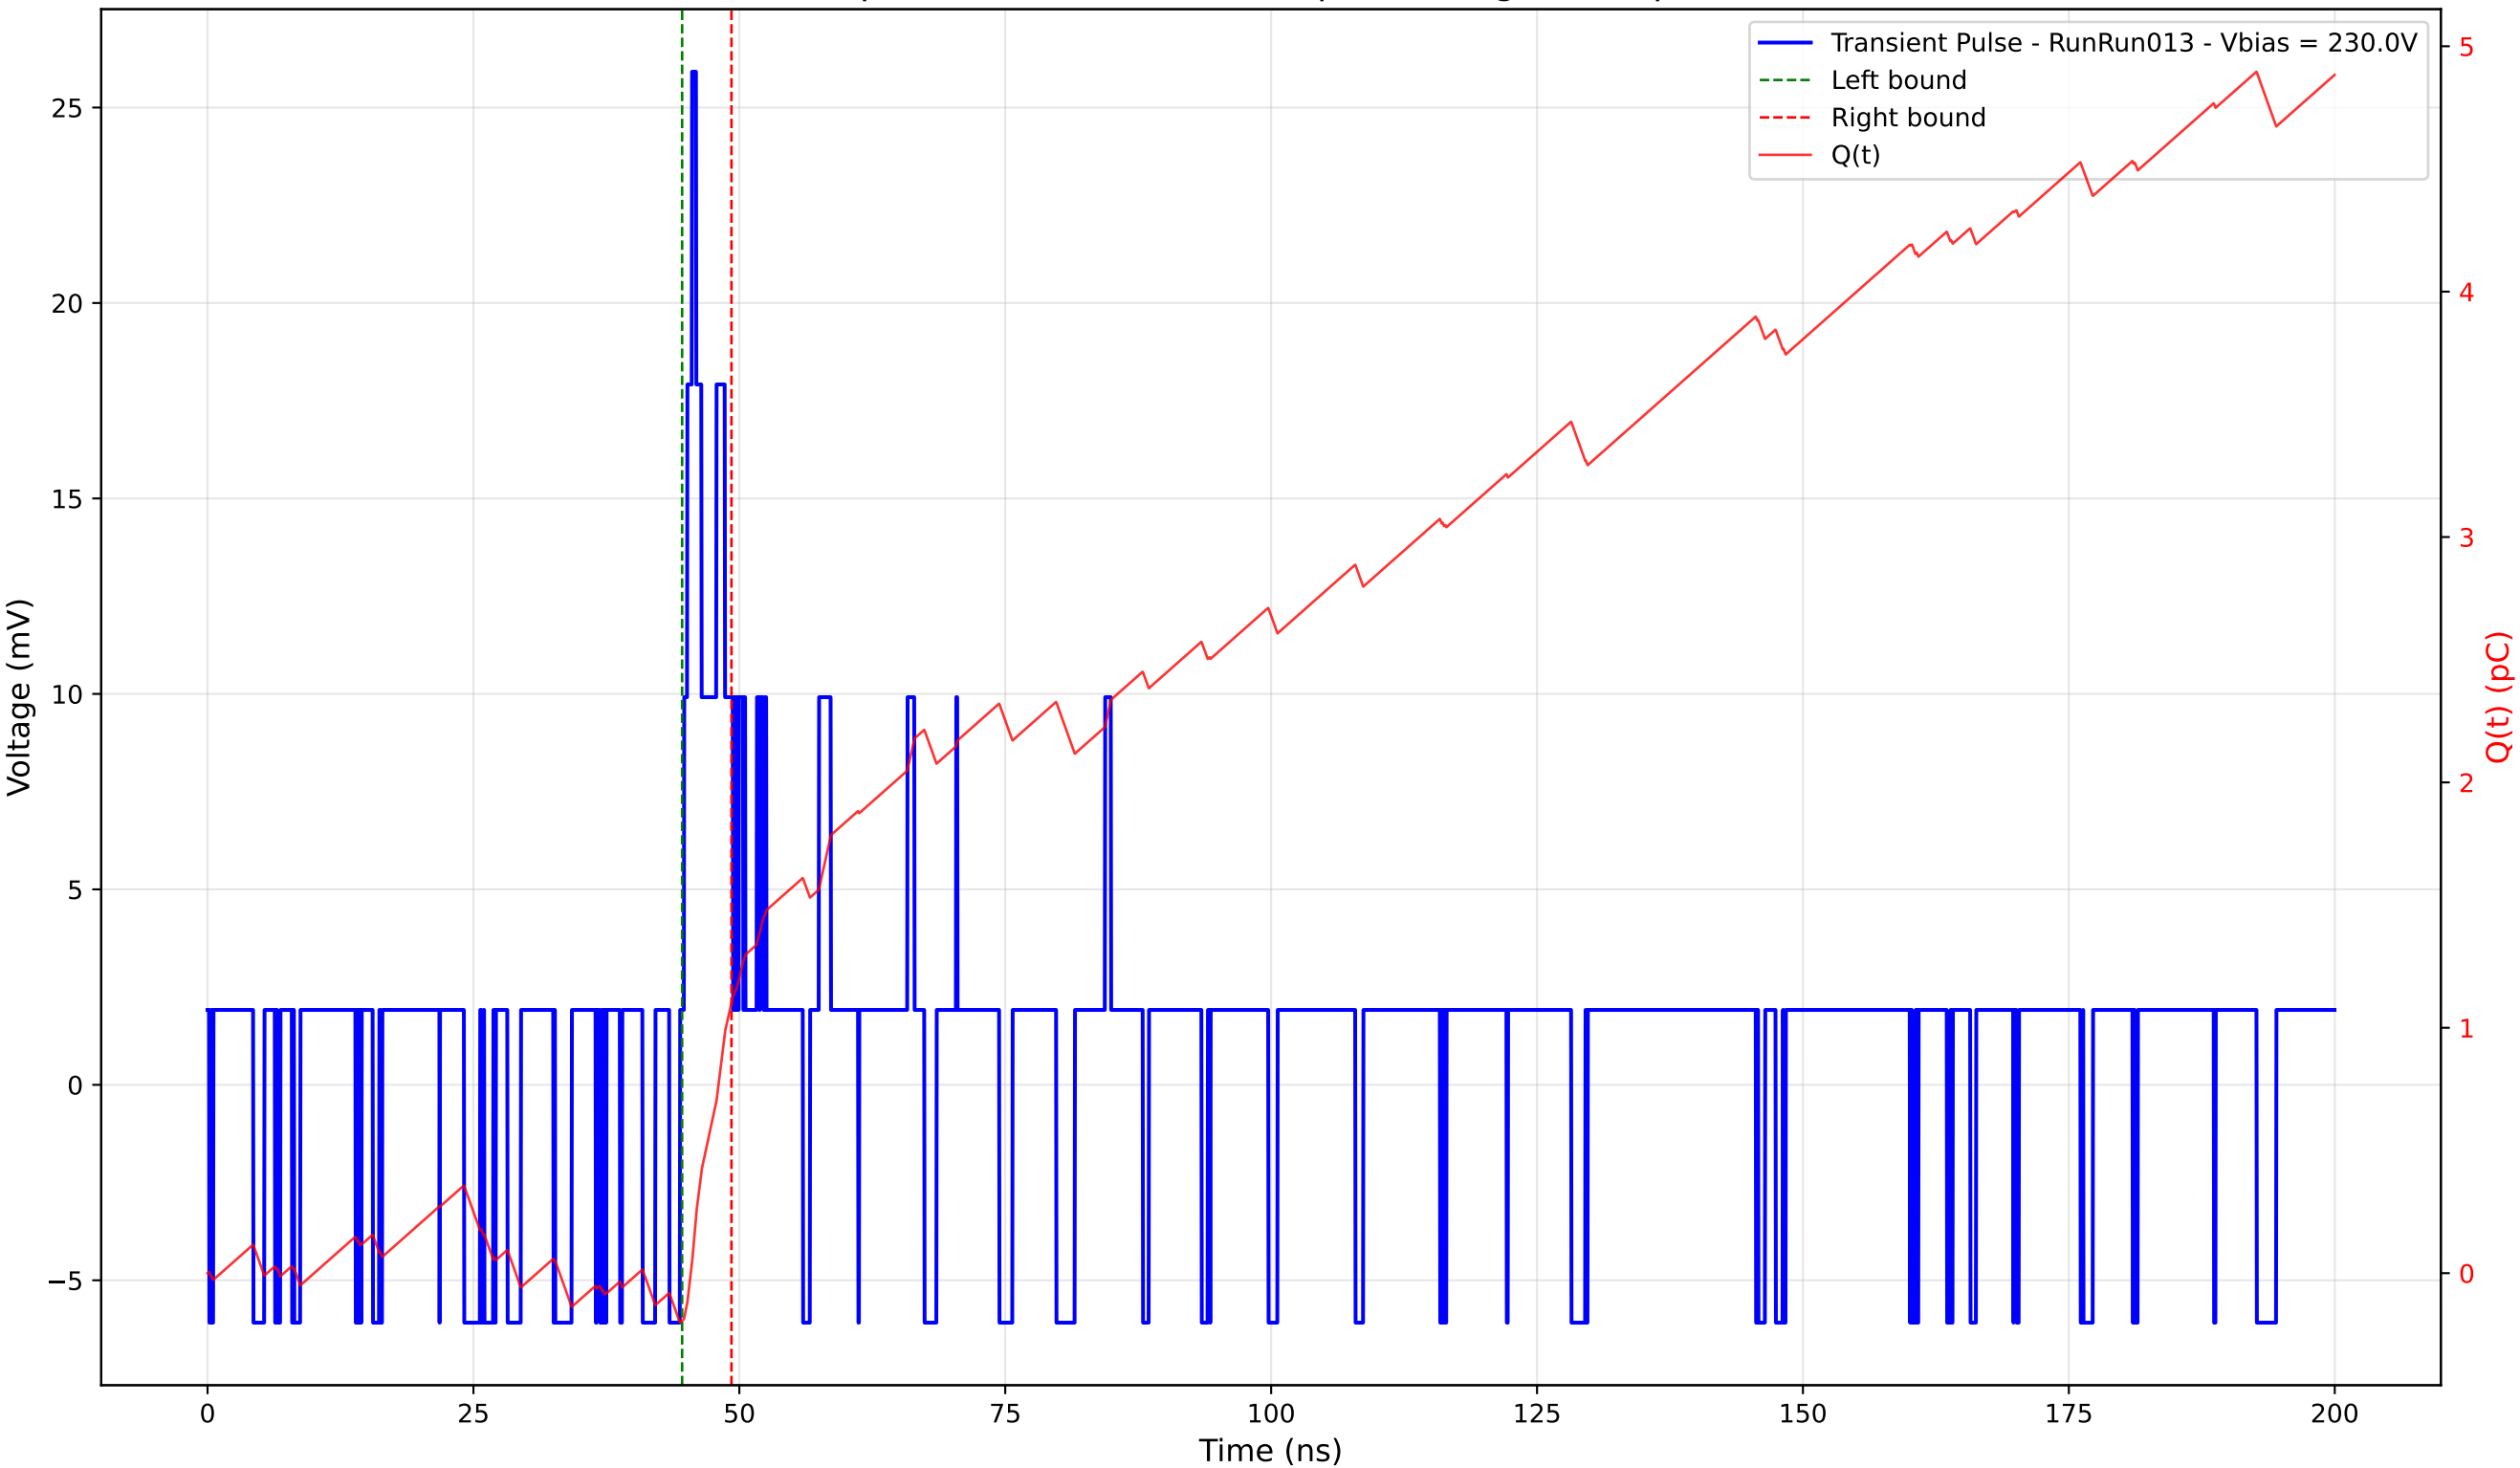


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 0.25 pC - Rise Time: 0.38 ns

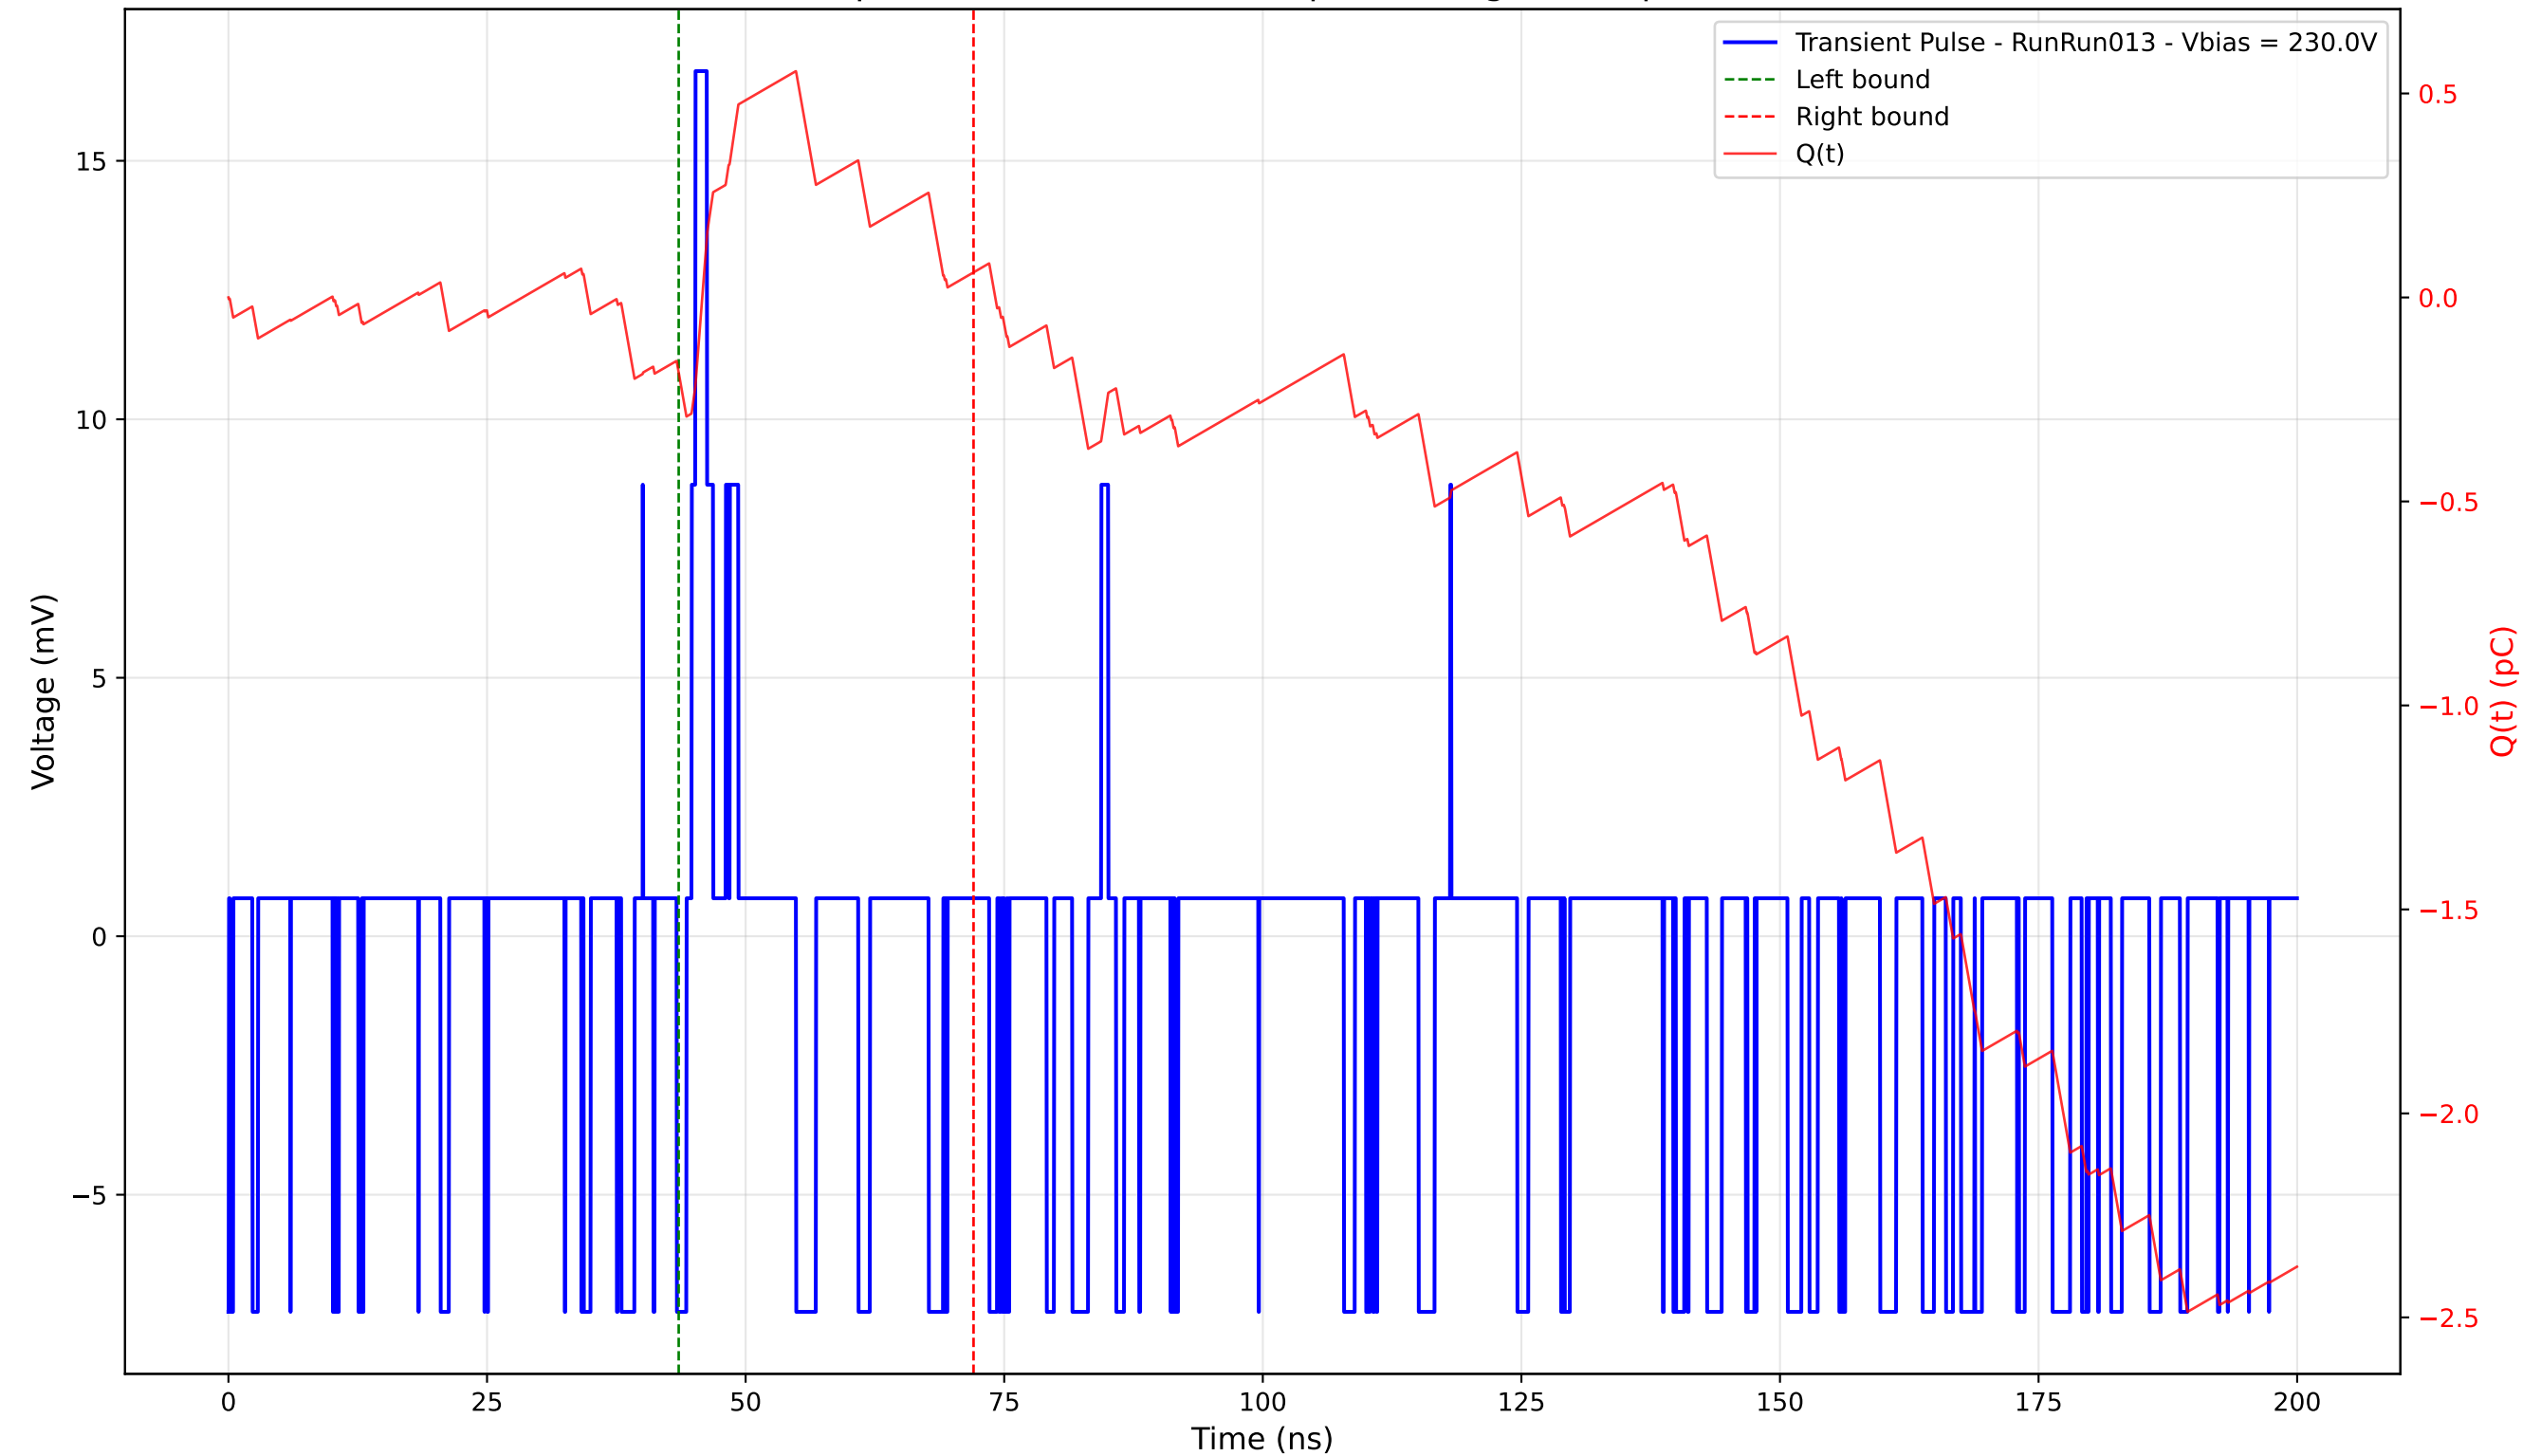


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 0.82 pC - Rise Time: 0.79 ns

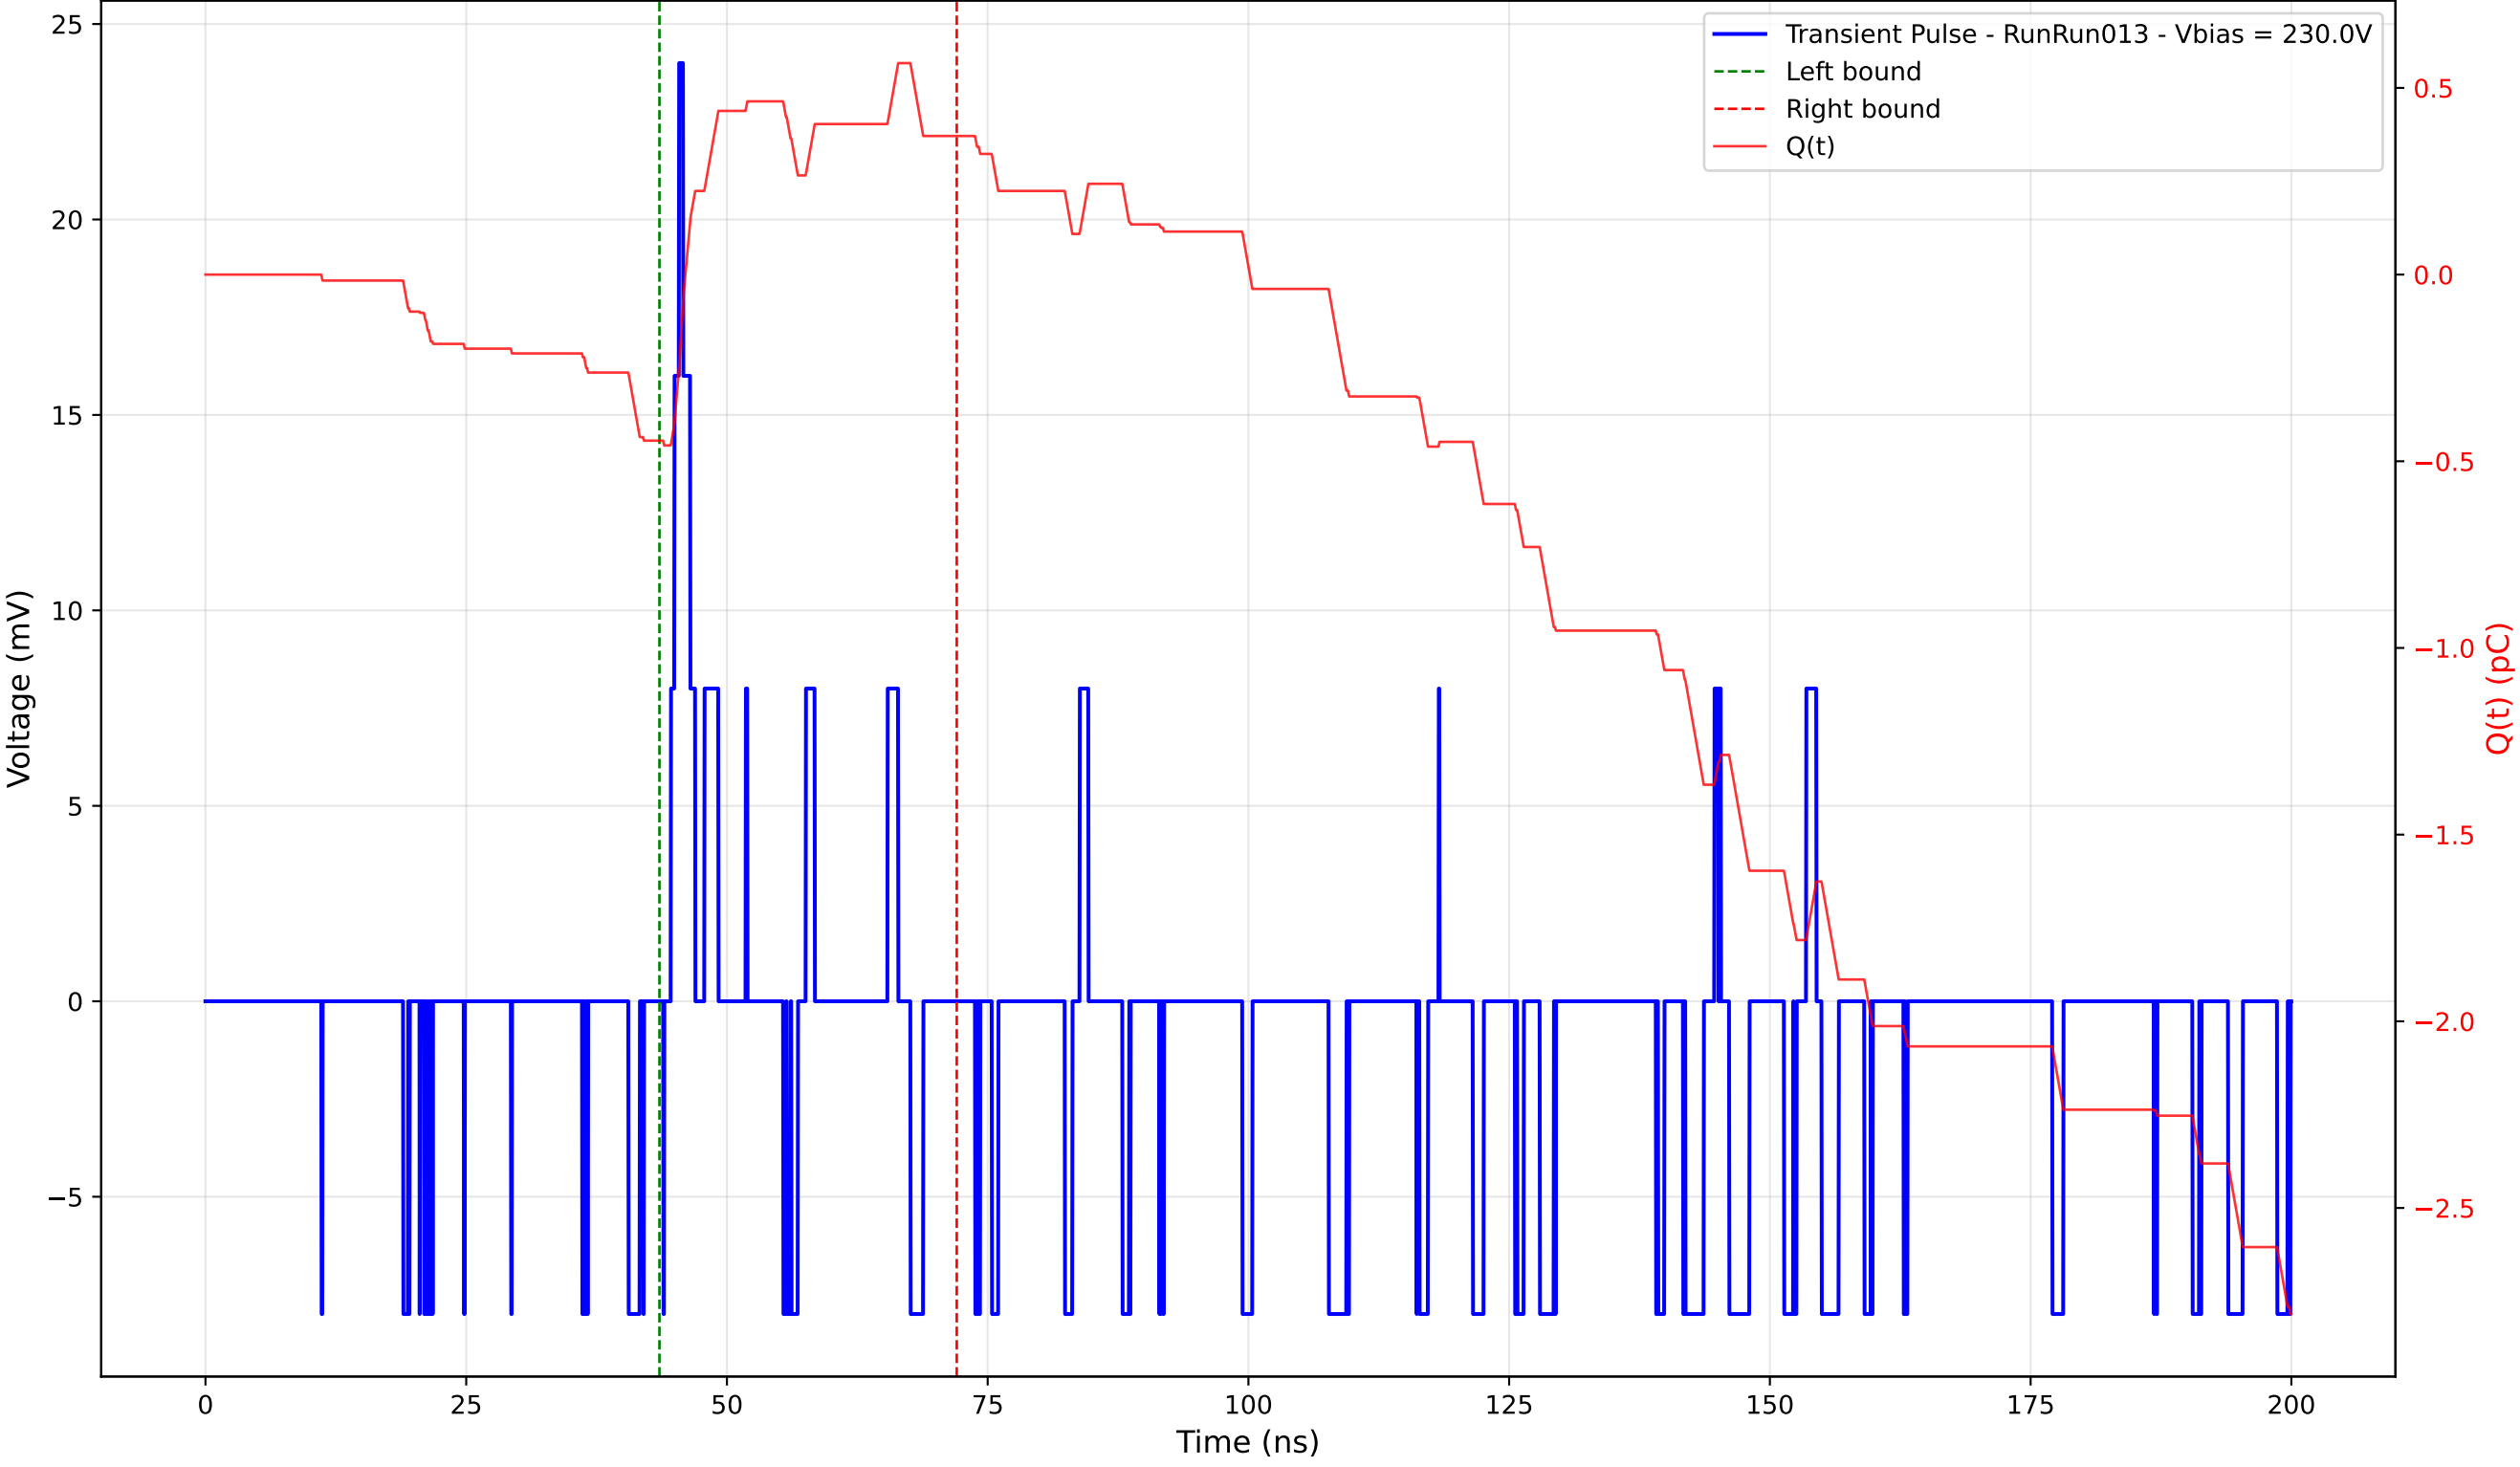


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 2.11 pC - Rise Time: 0.91 ns

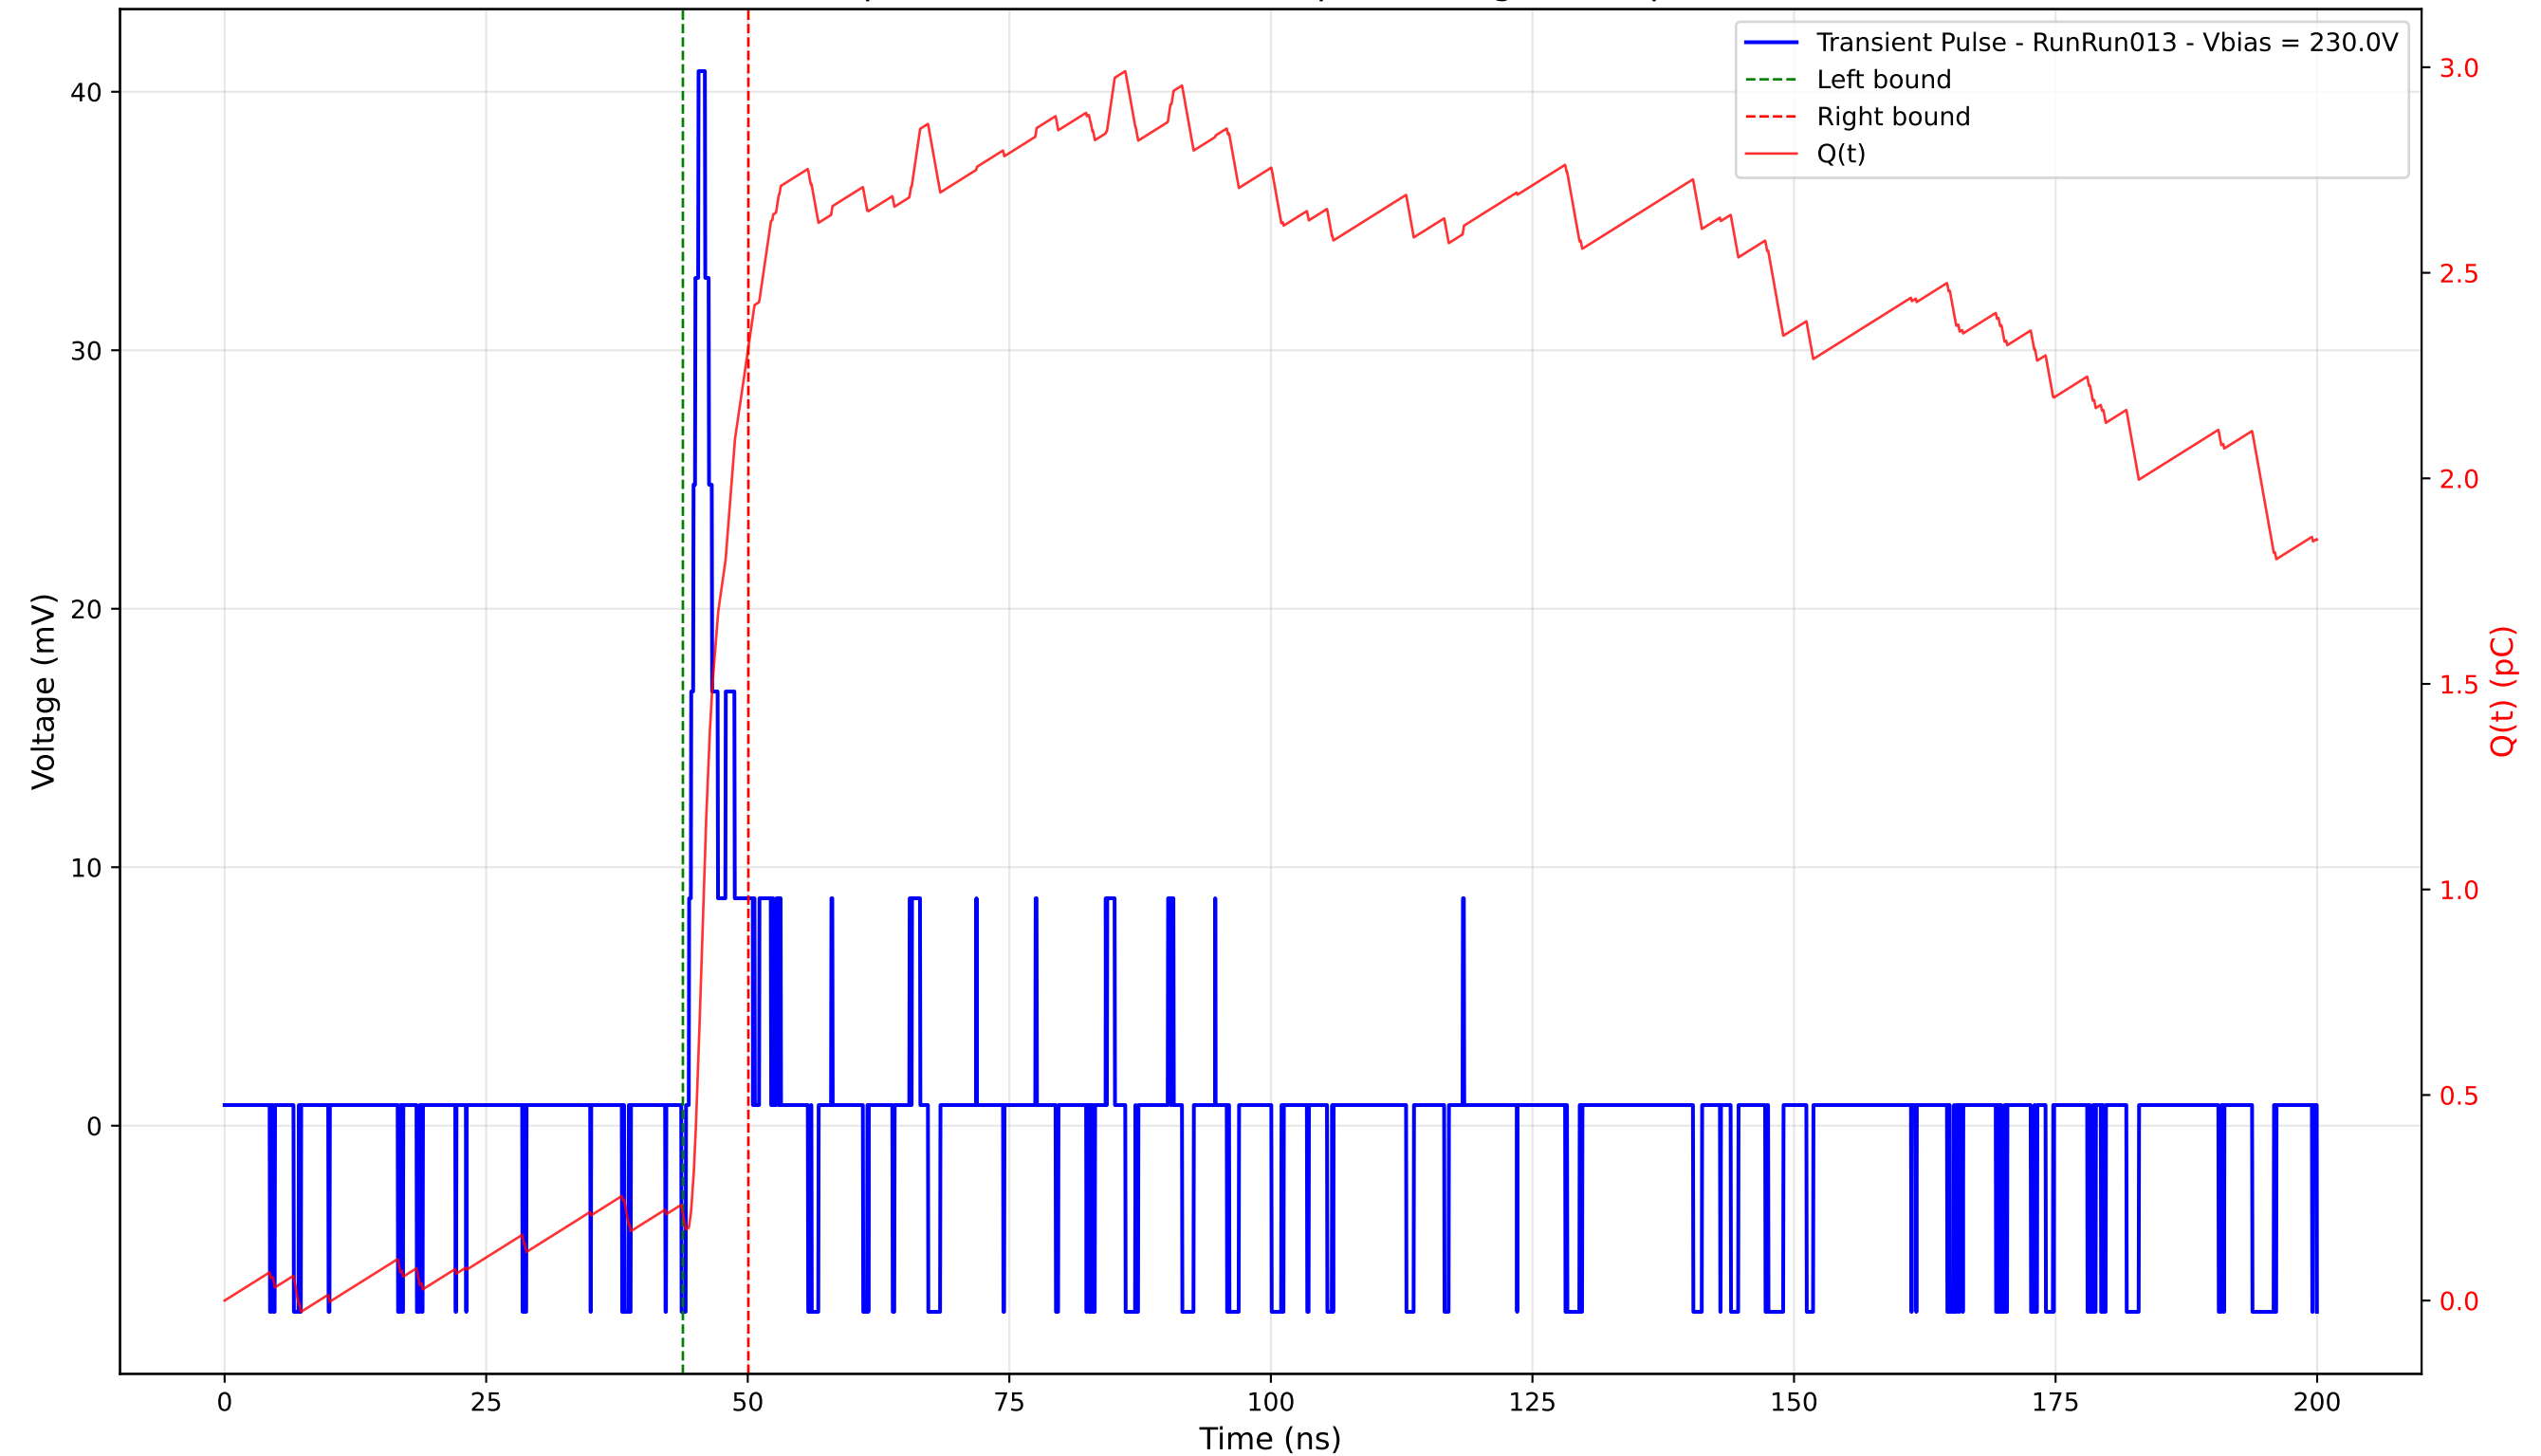


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 4.79 pC - Rise Time: 0.88 ns

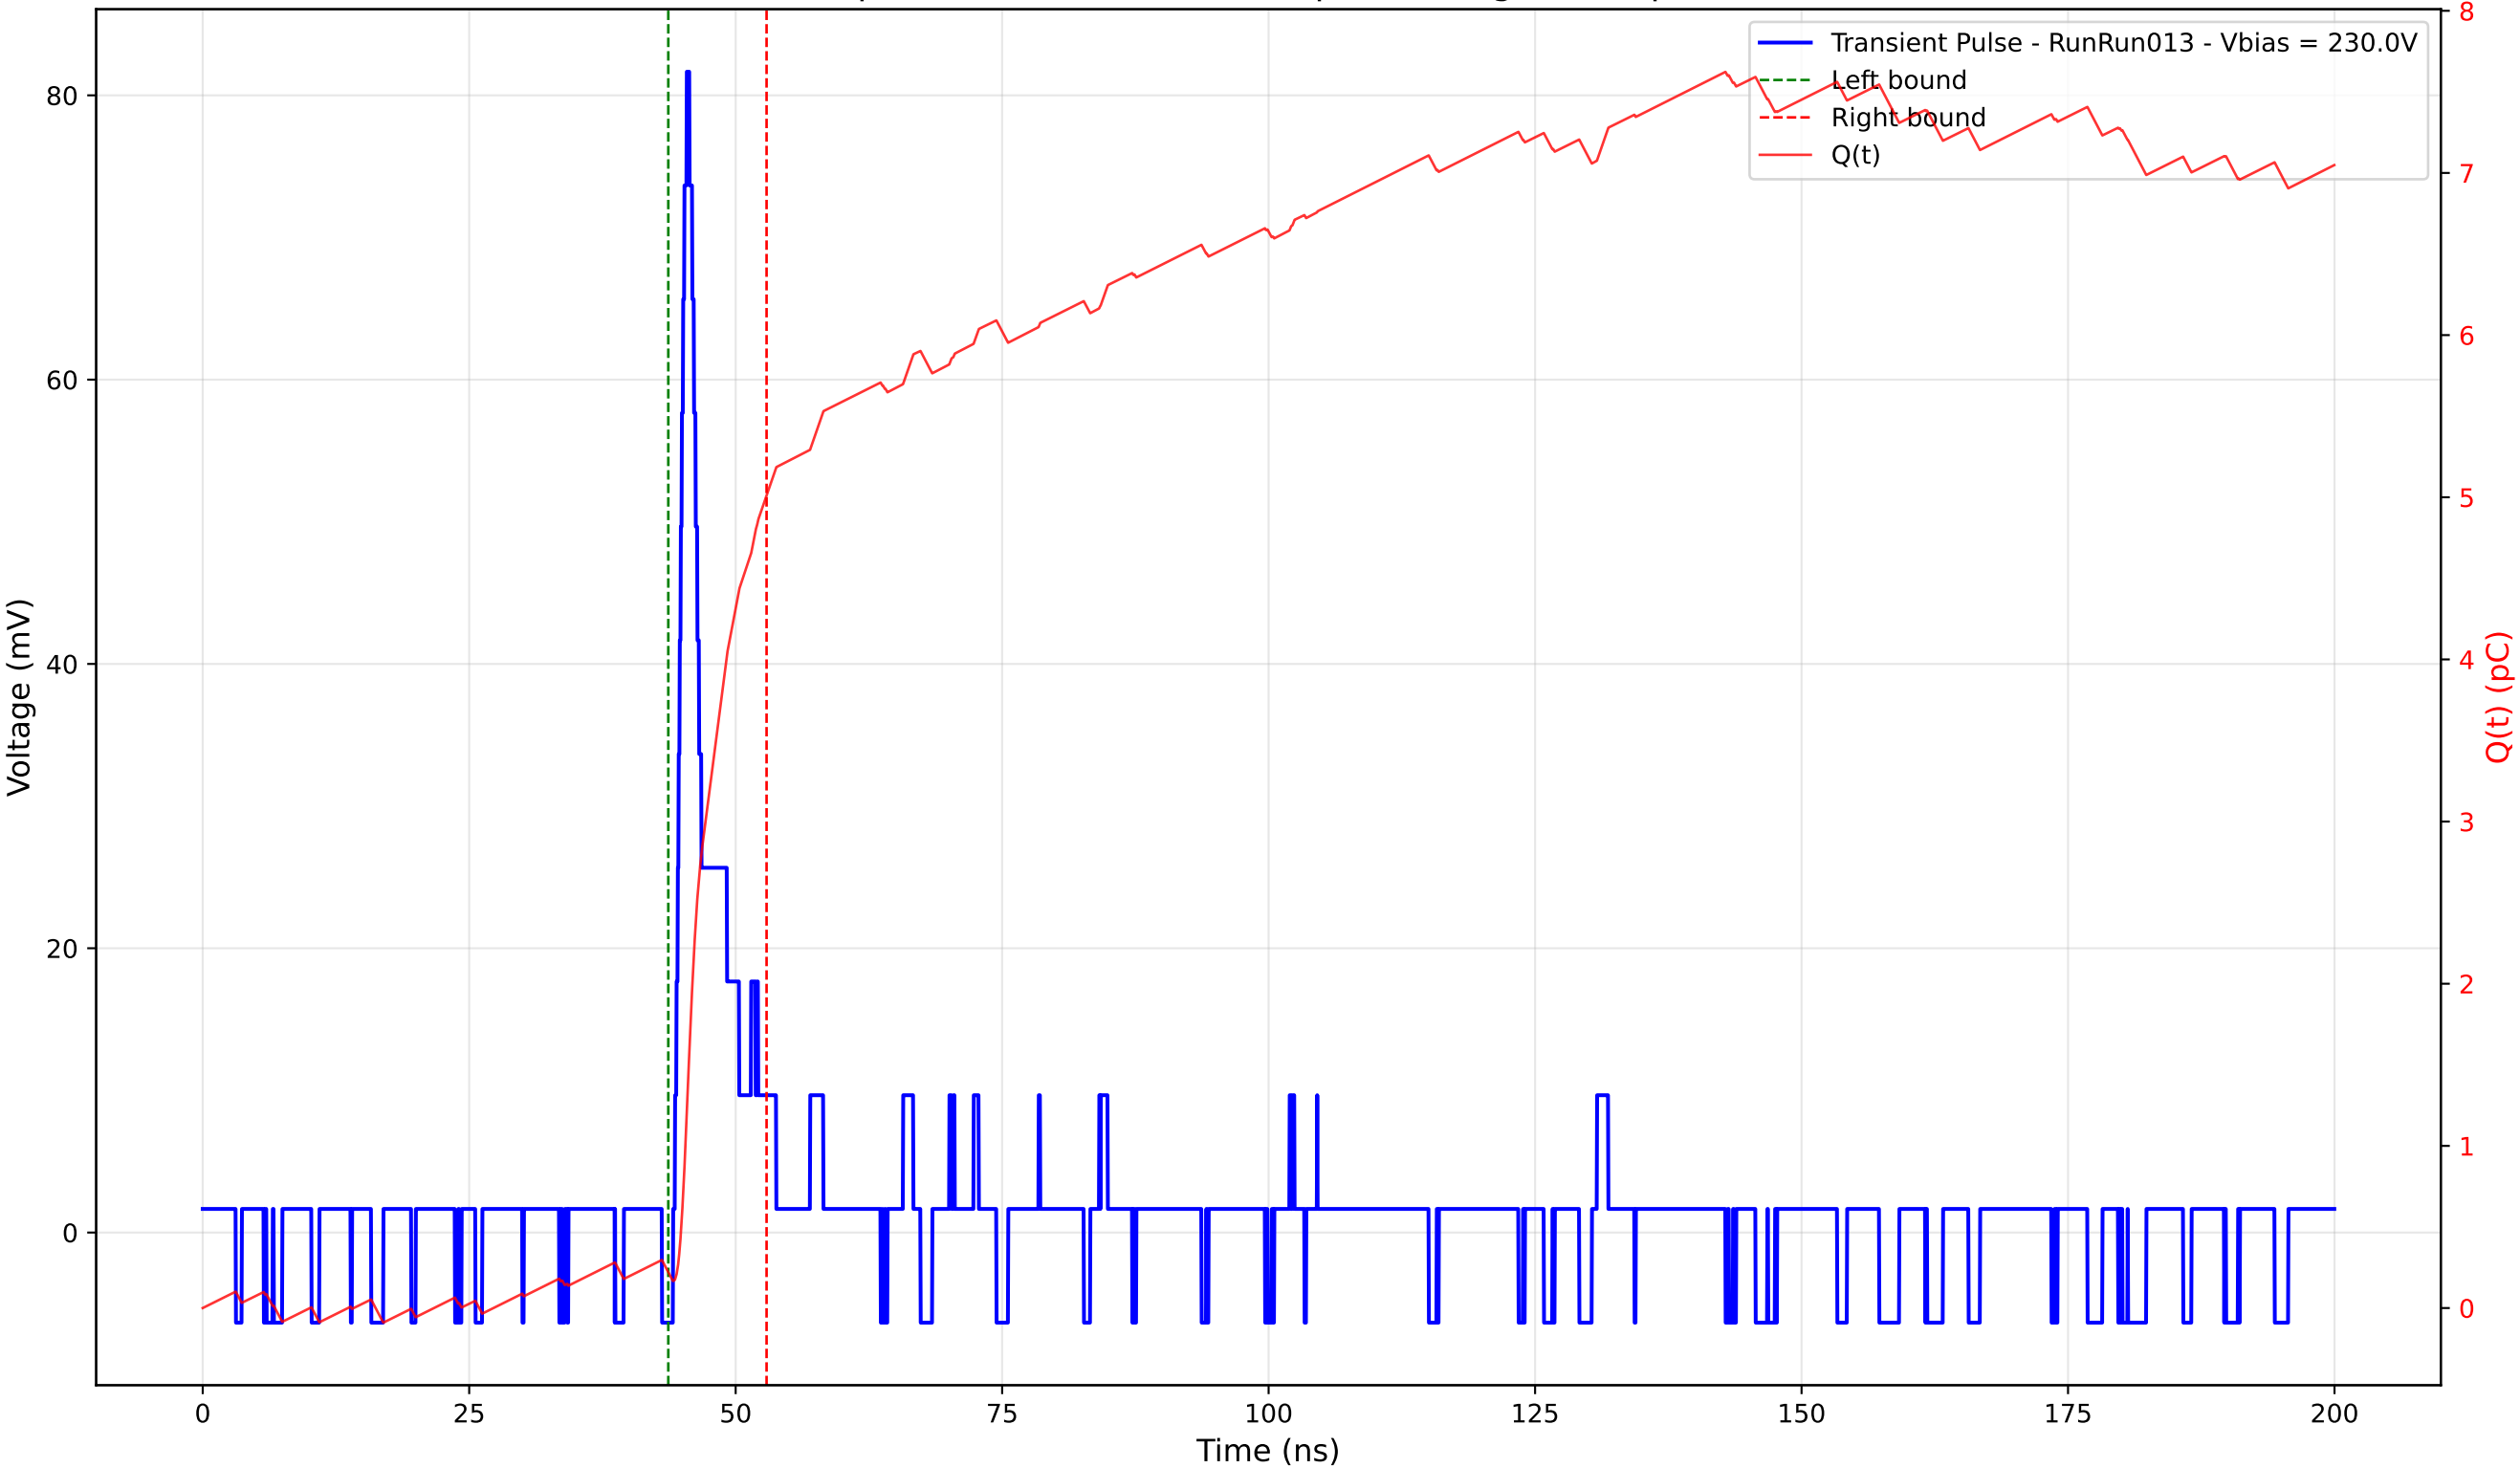


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 9.44 pC - Rise Time: 0.93 ns

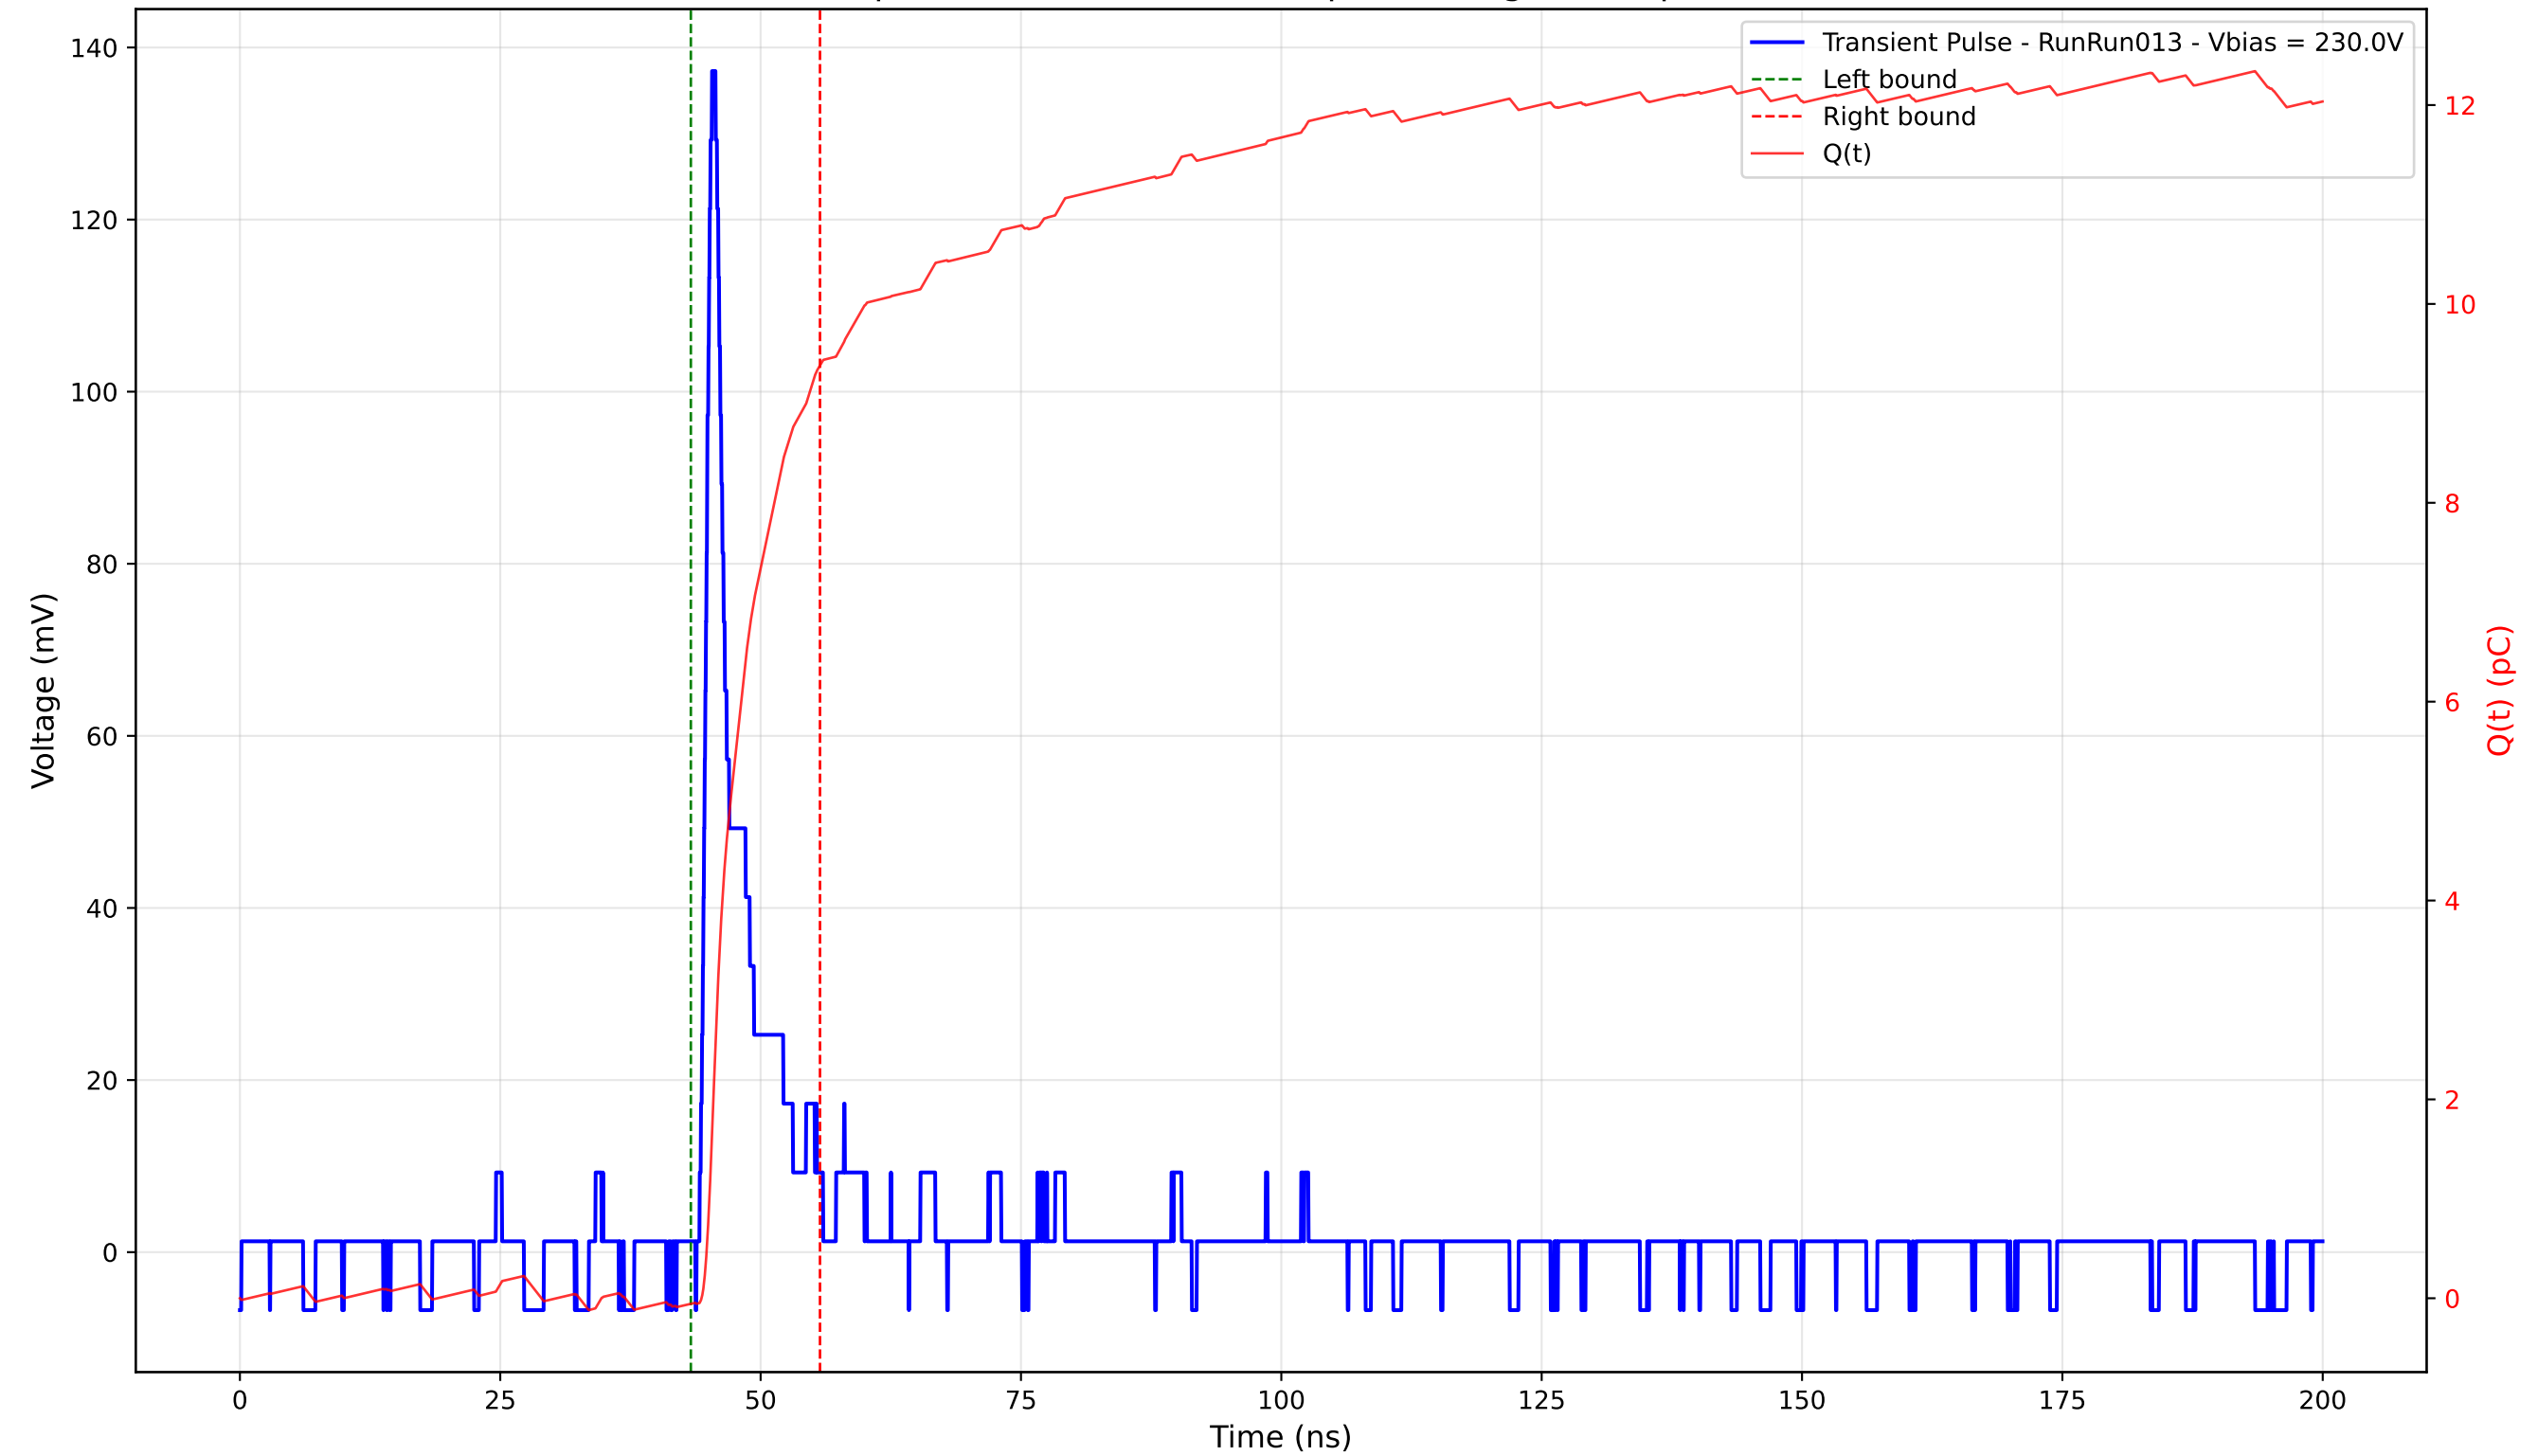


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 14.08 pC - Rise Time: 0.89 ns

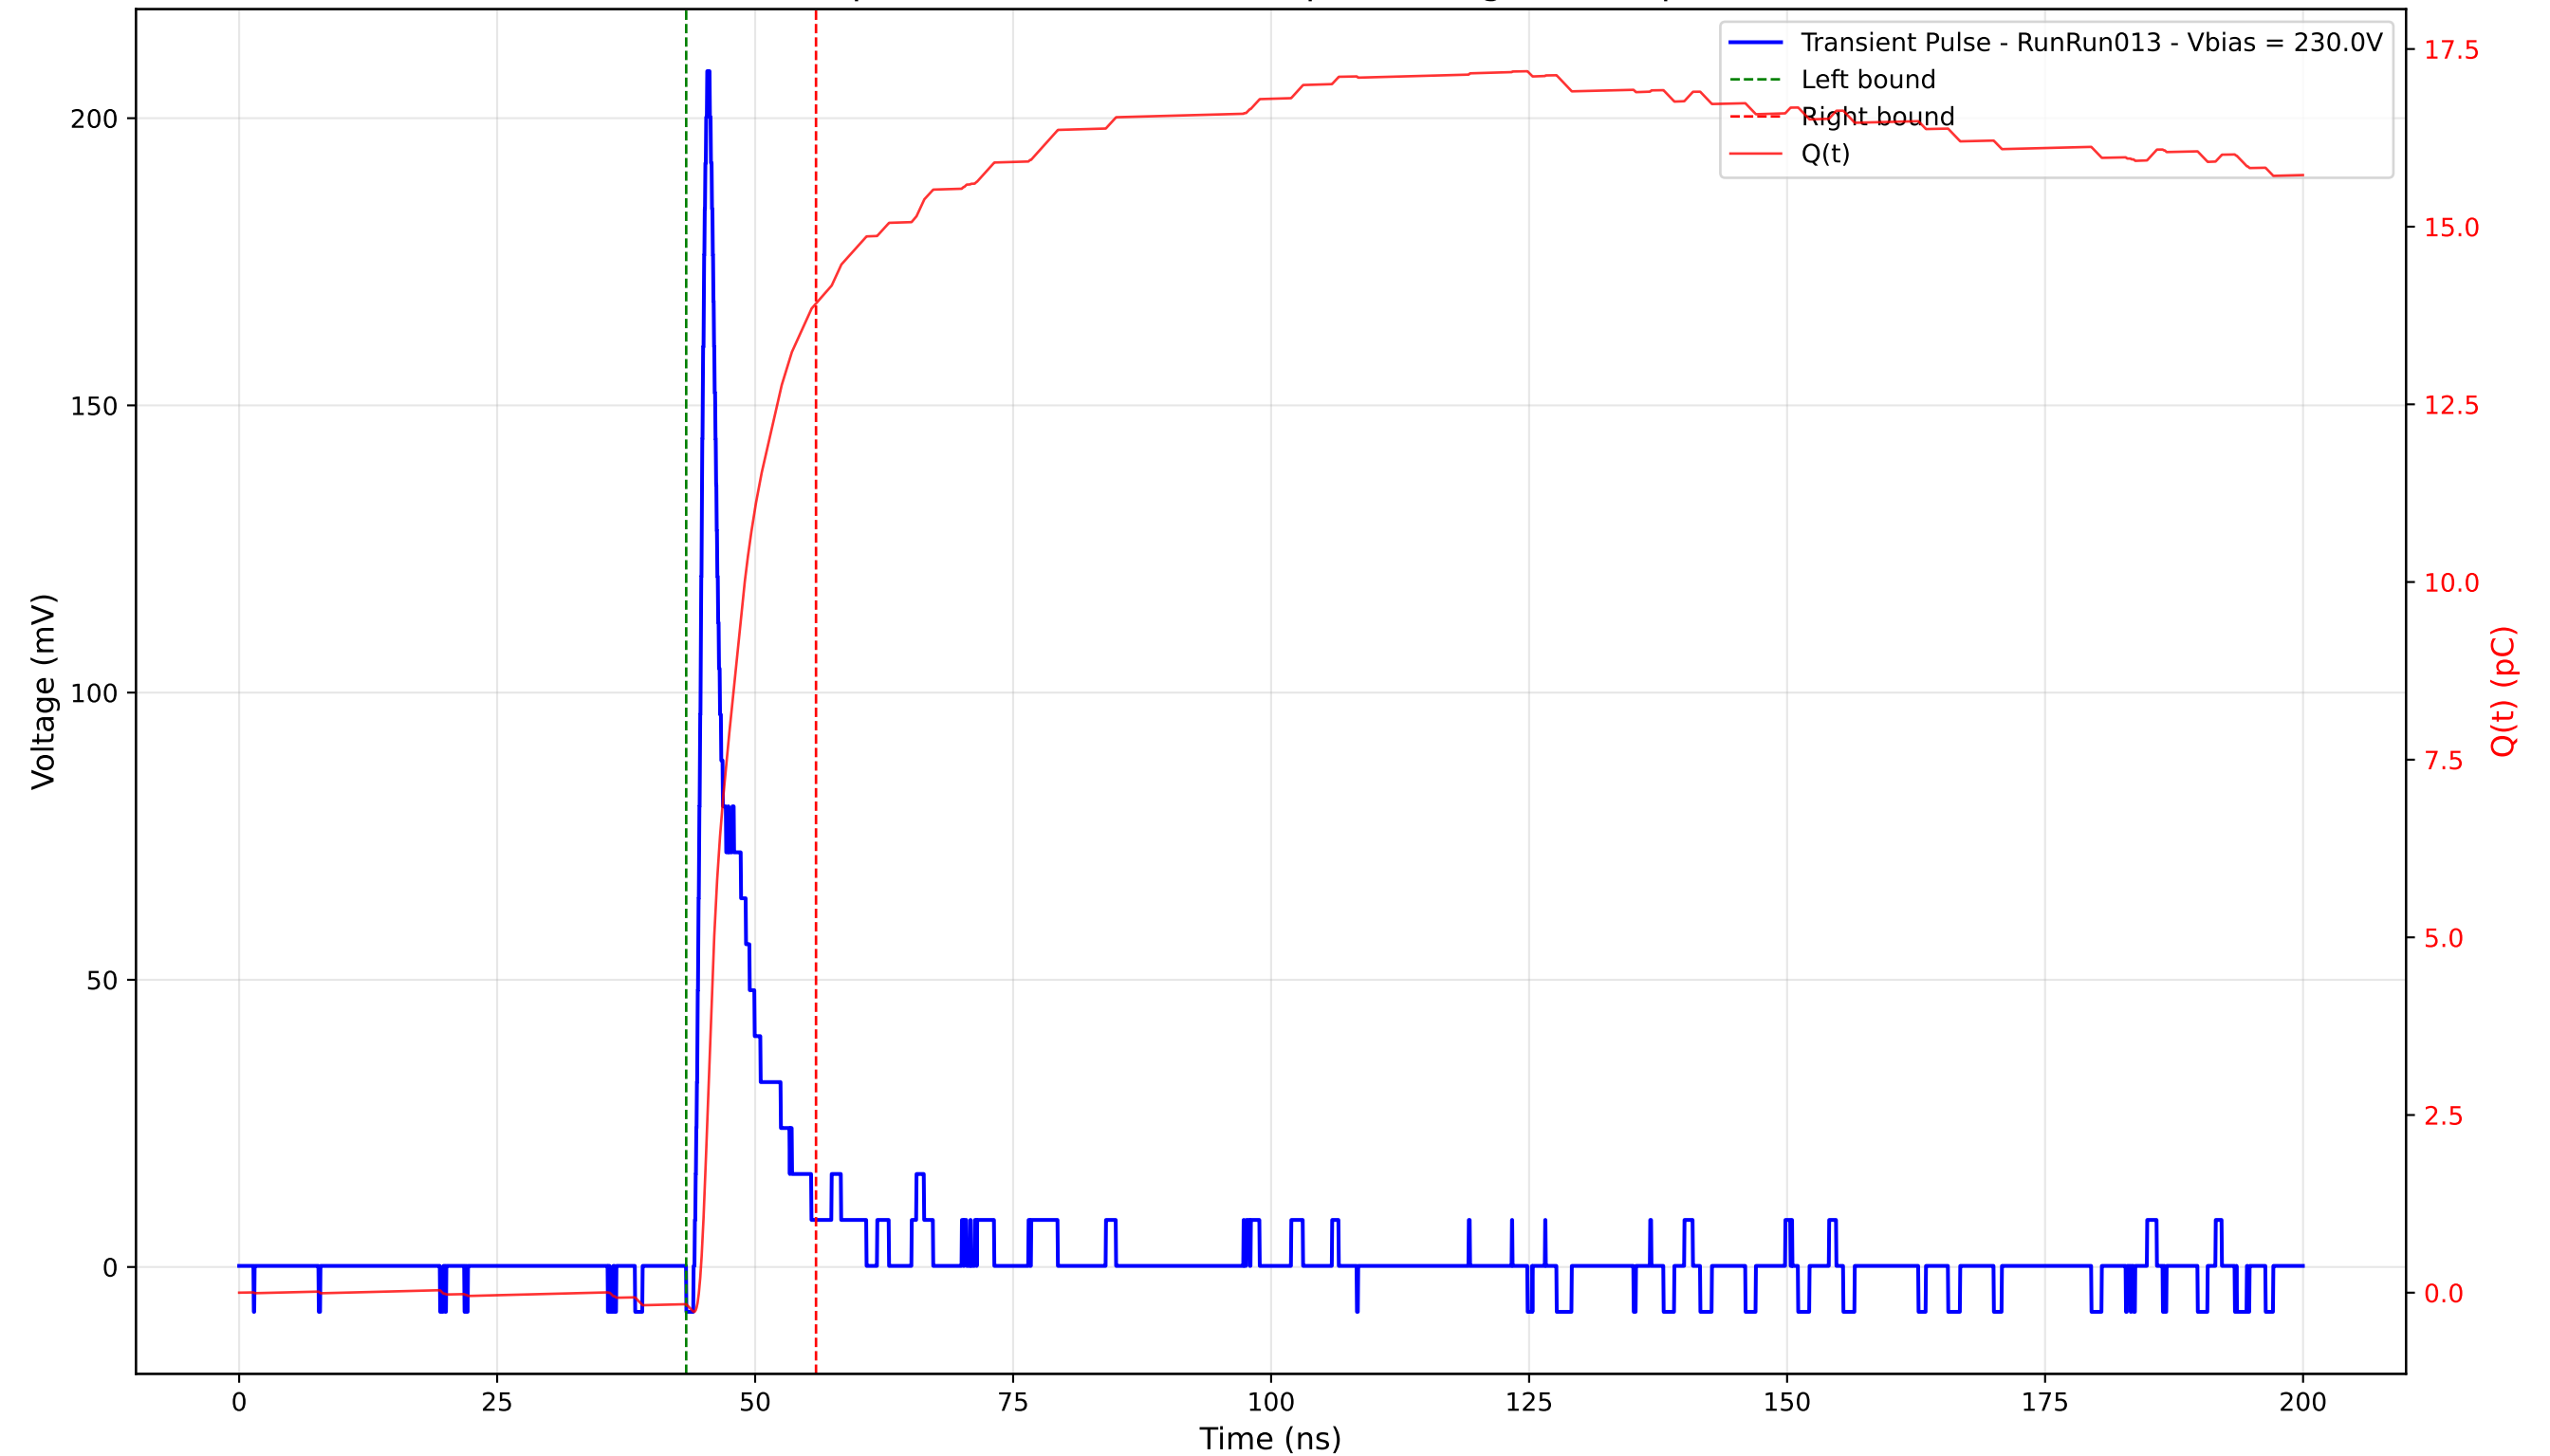


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 20.92 pC - Rise Time: 0.89 ns

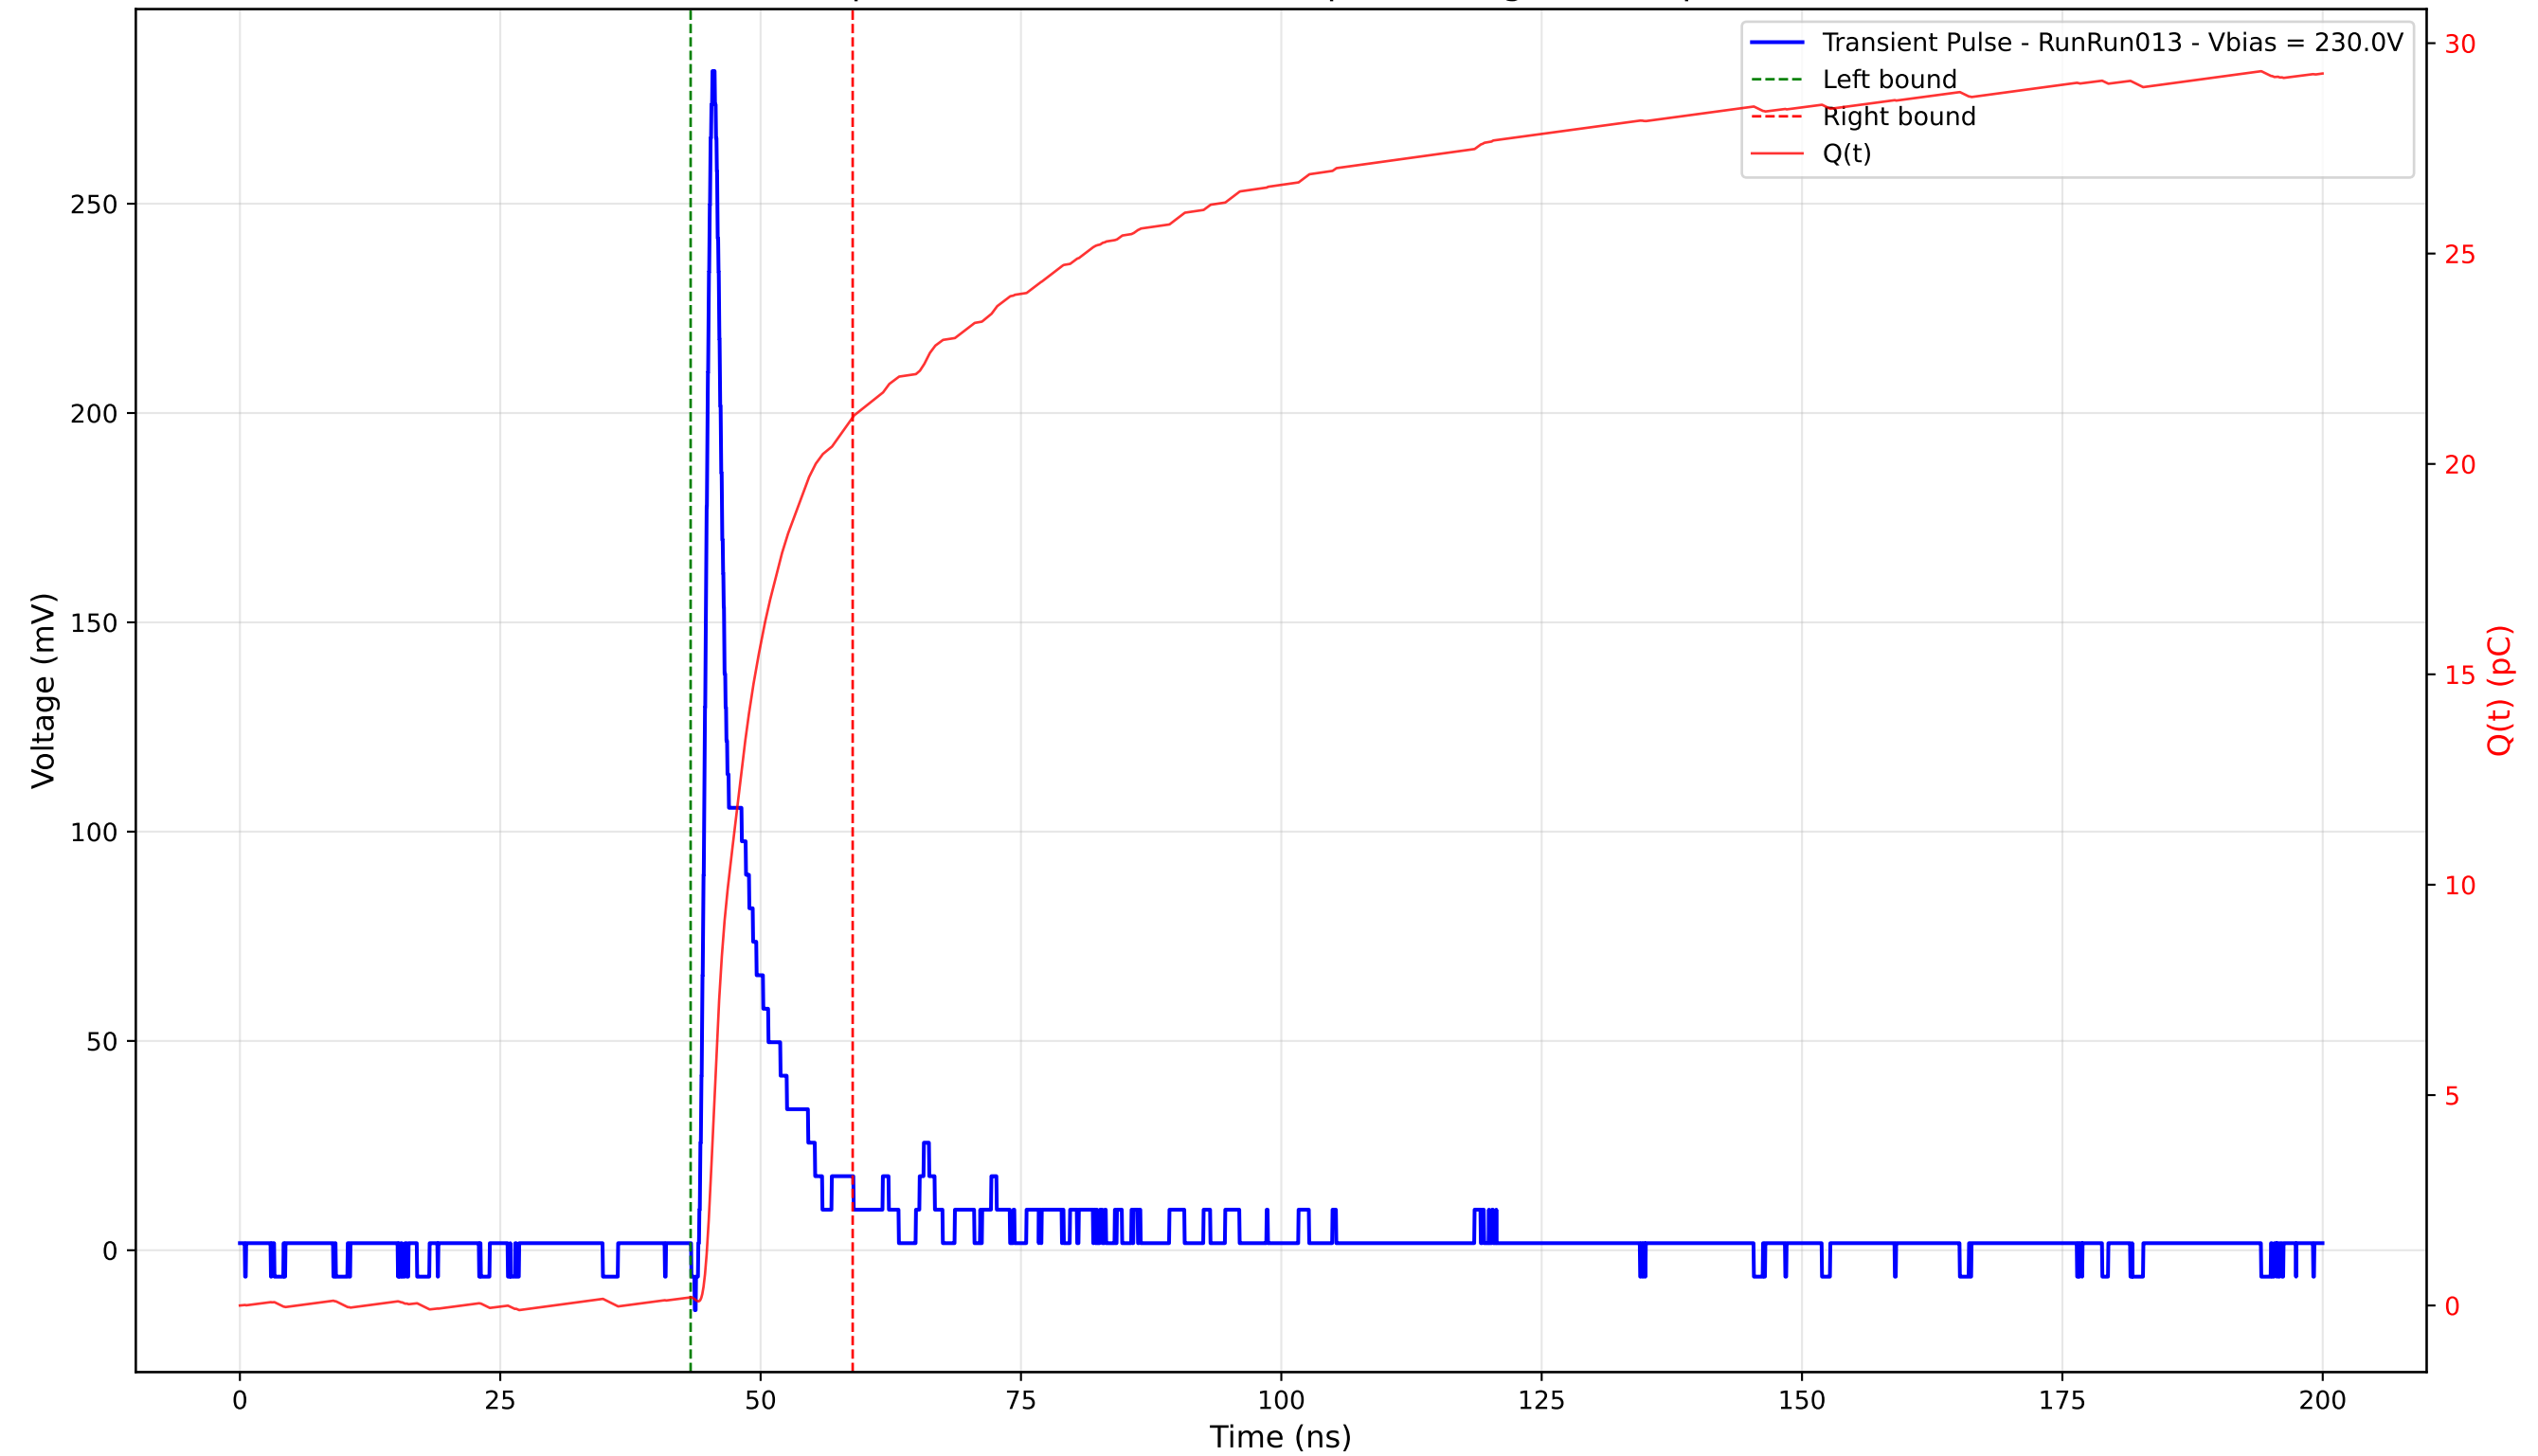


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 26.56 pC - Rise Time: 0.90 ns

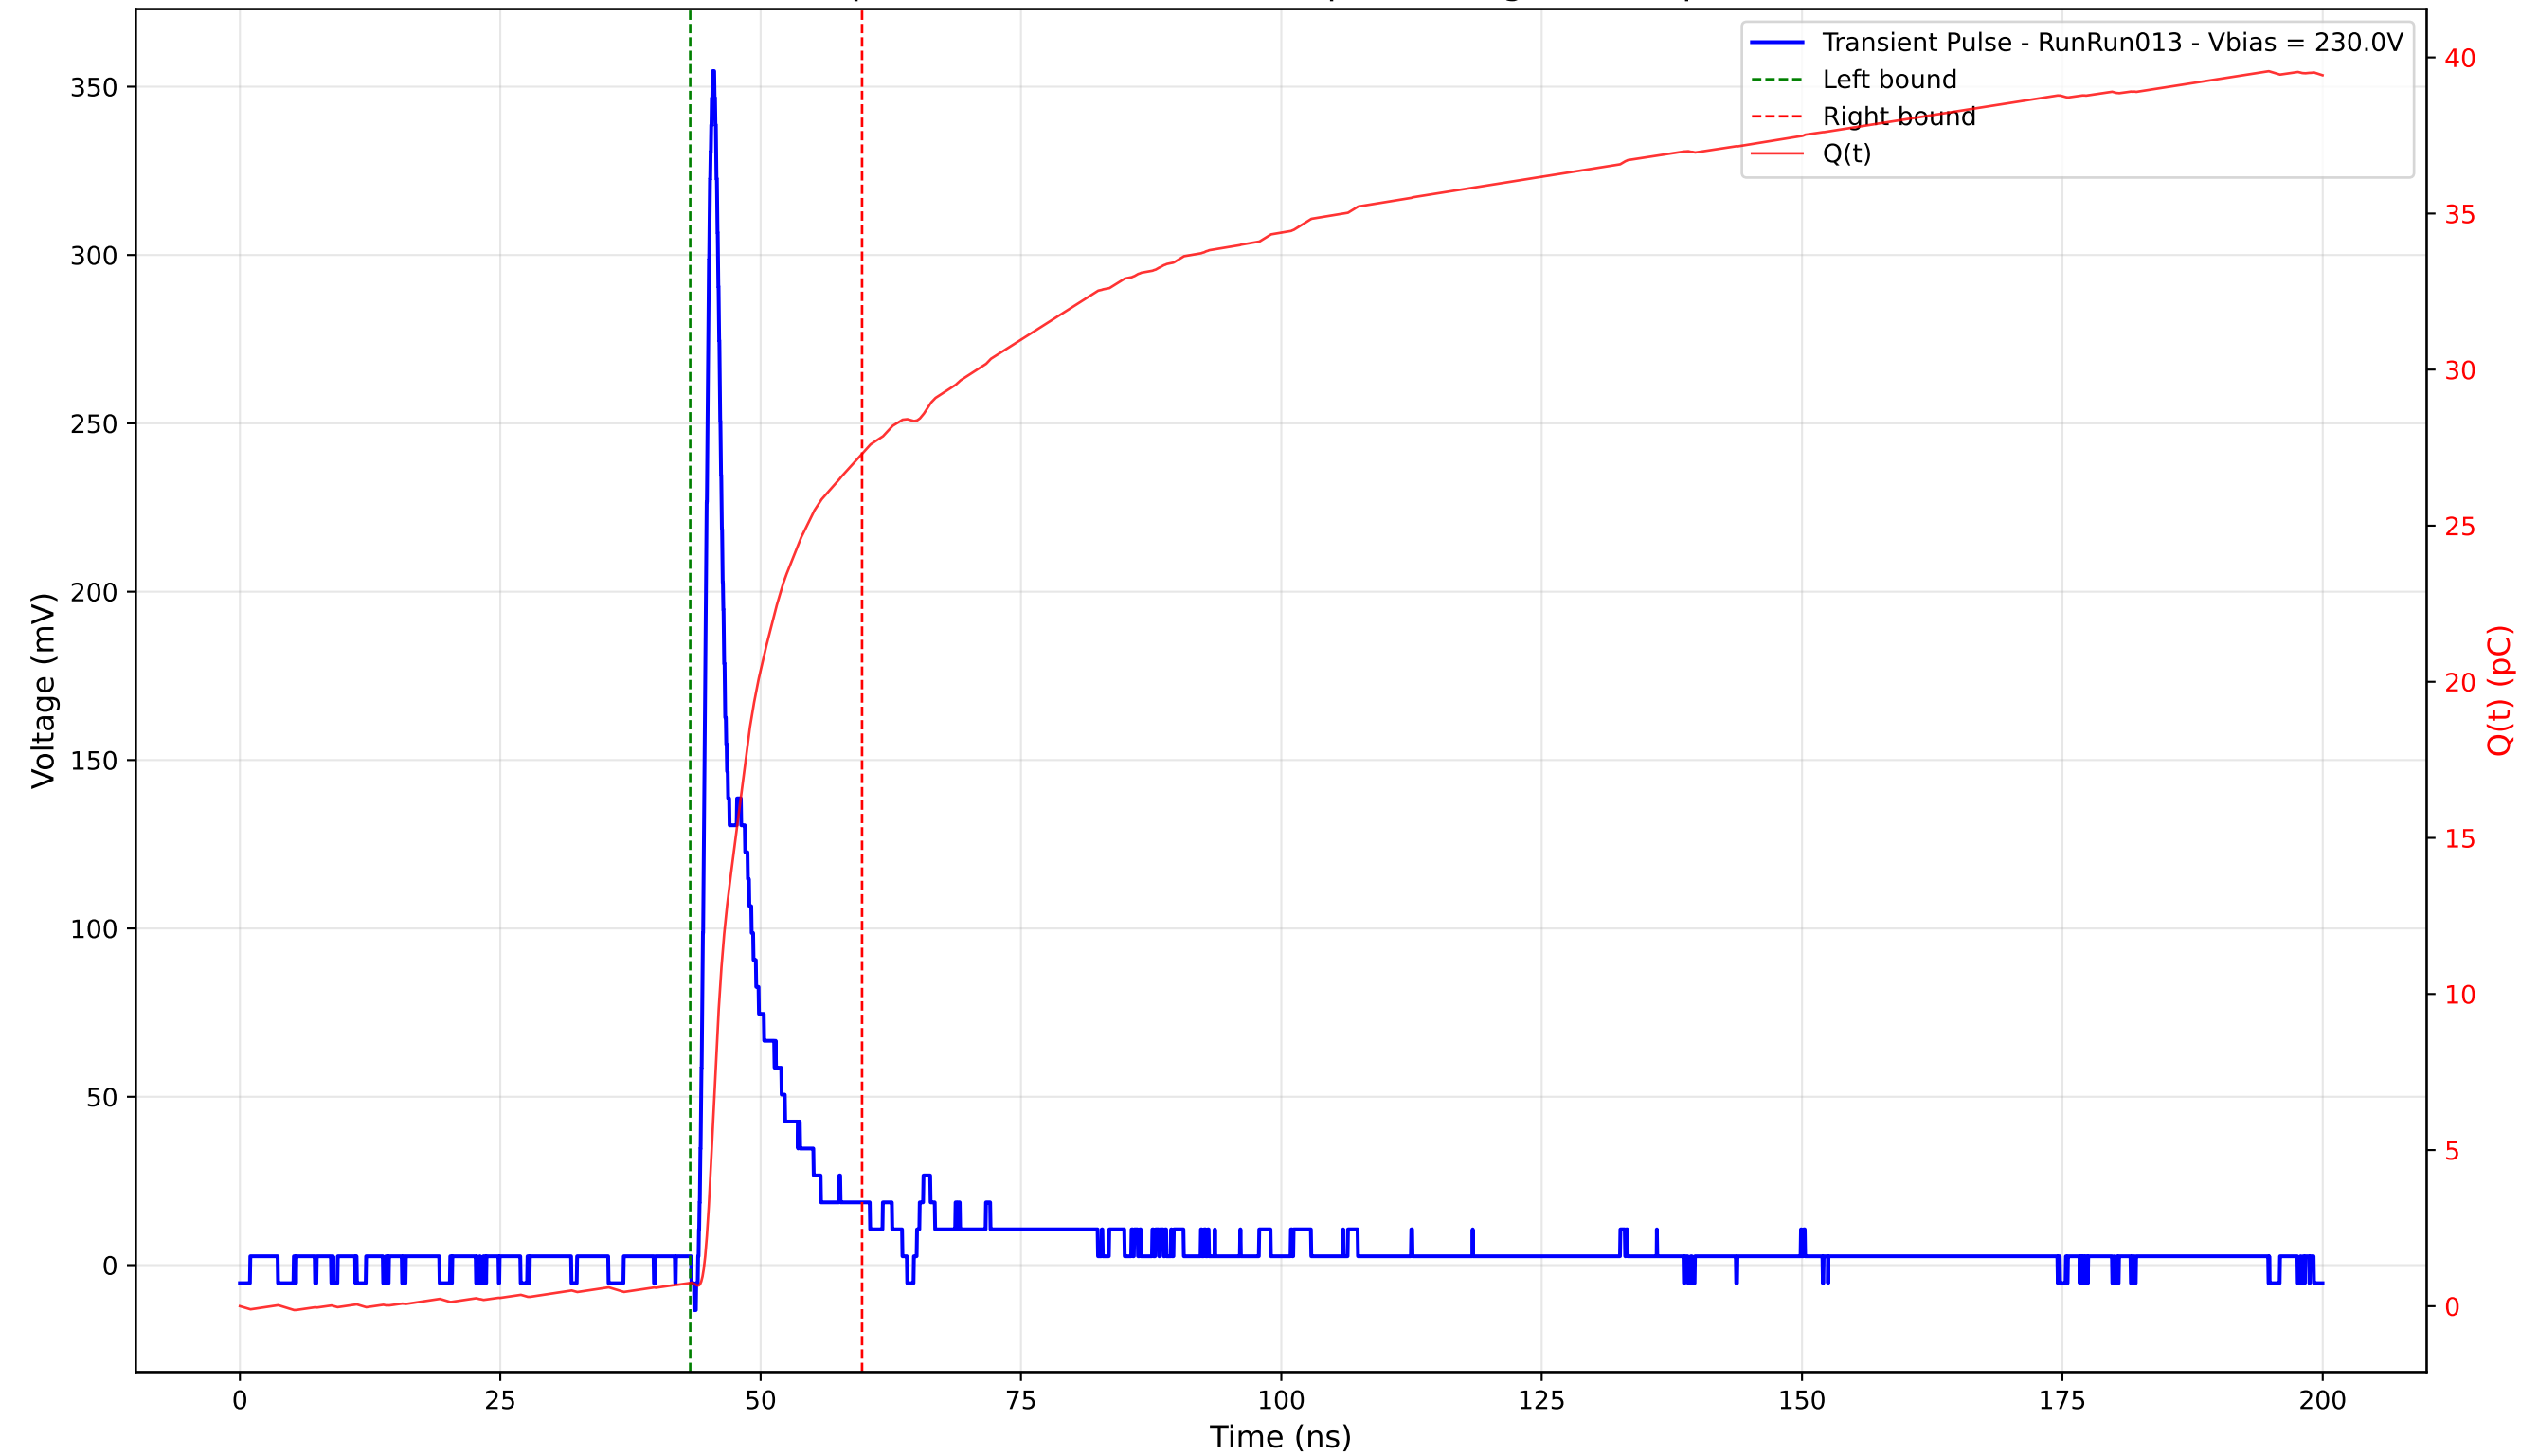


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 31.09 pC - Rise Time: 0.88 ns

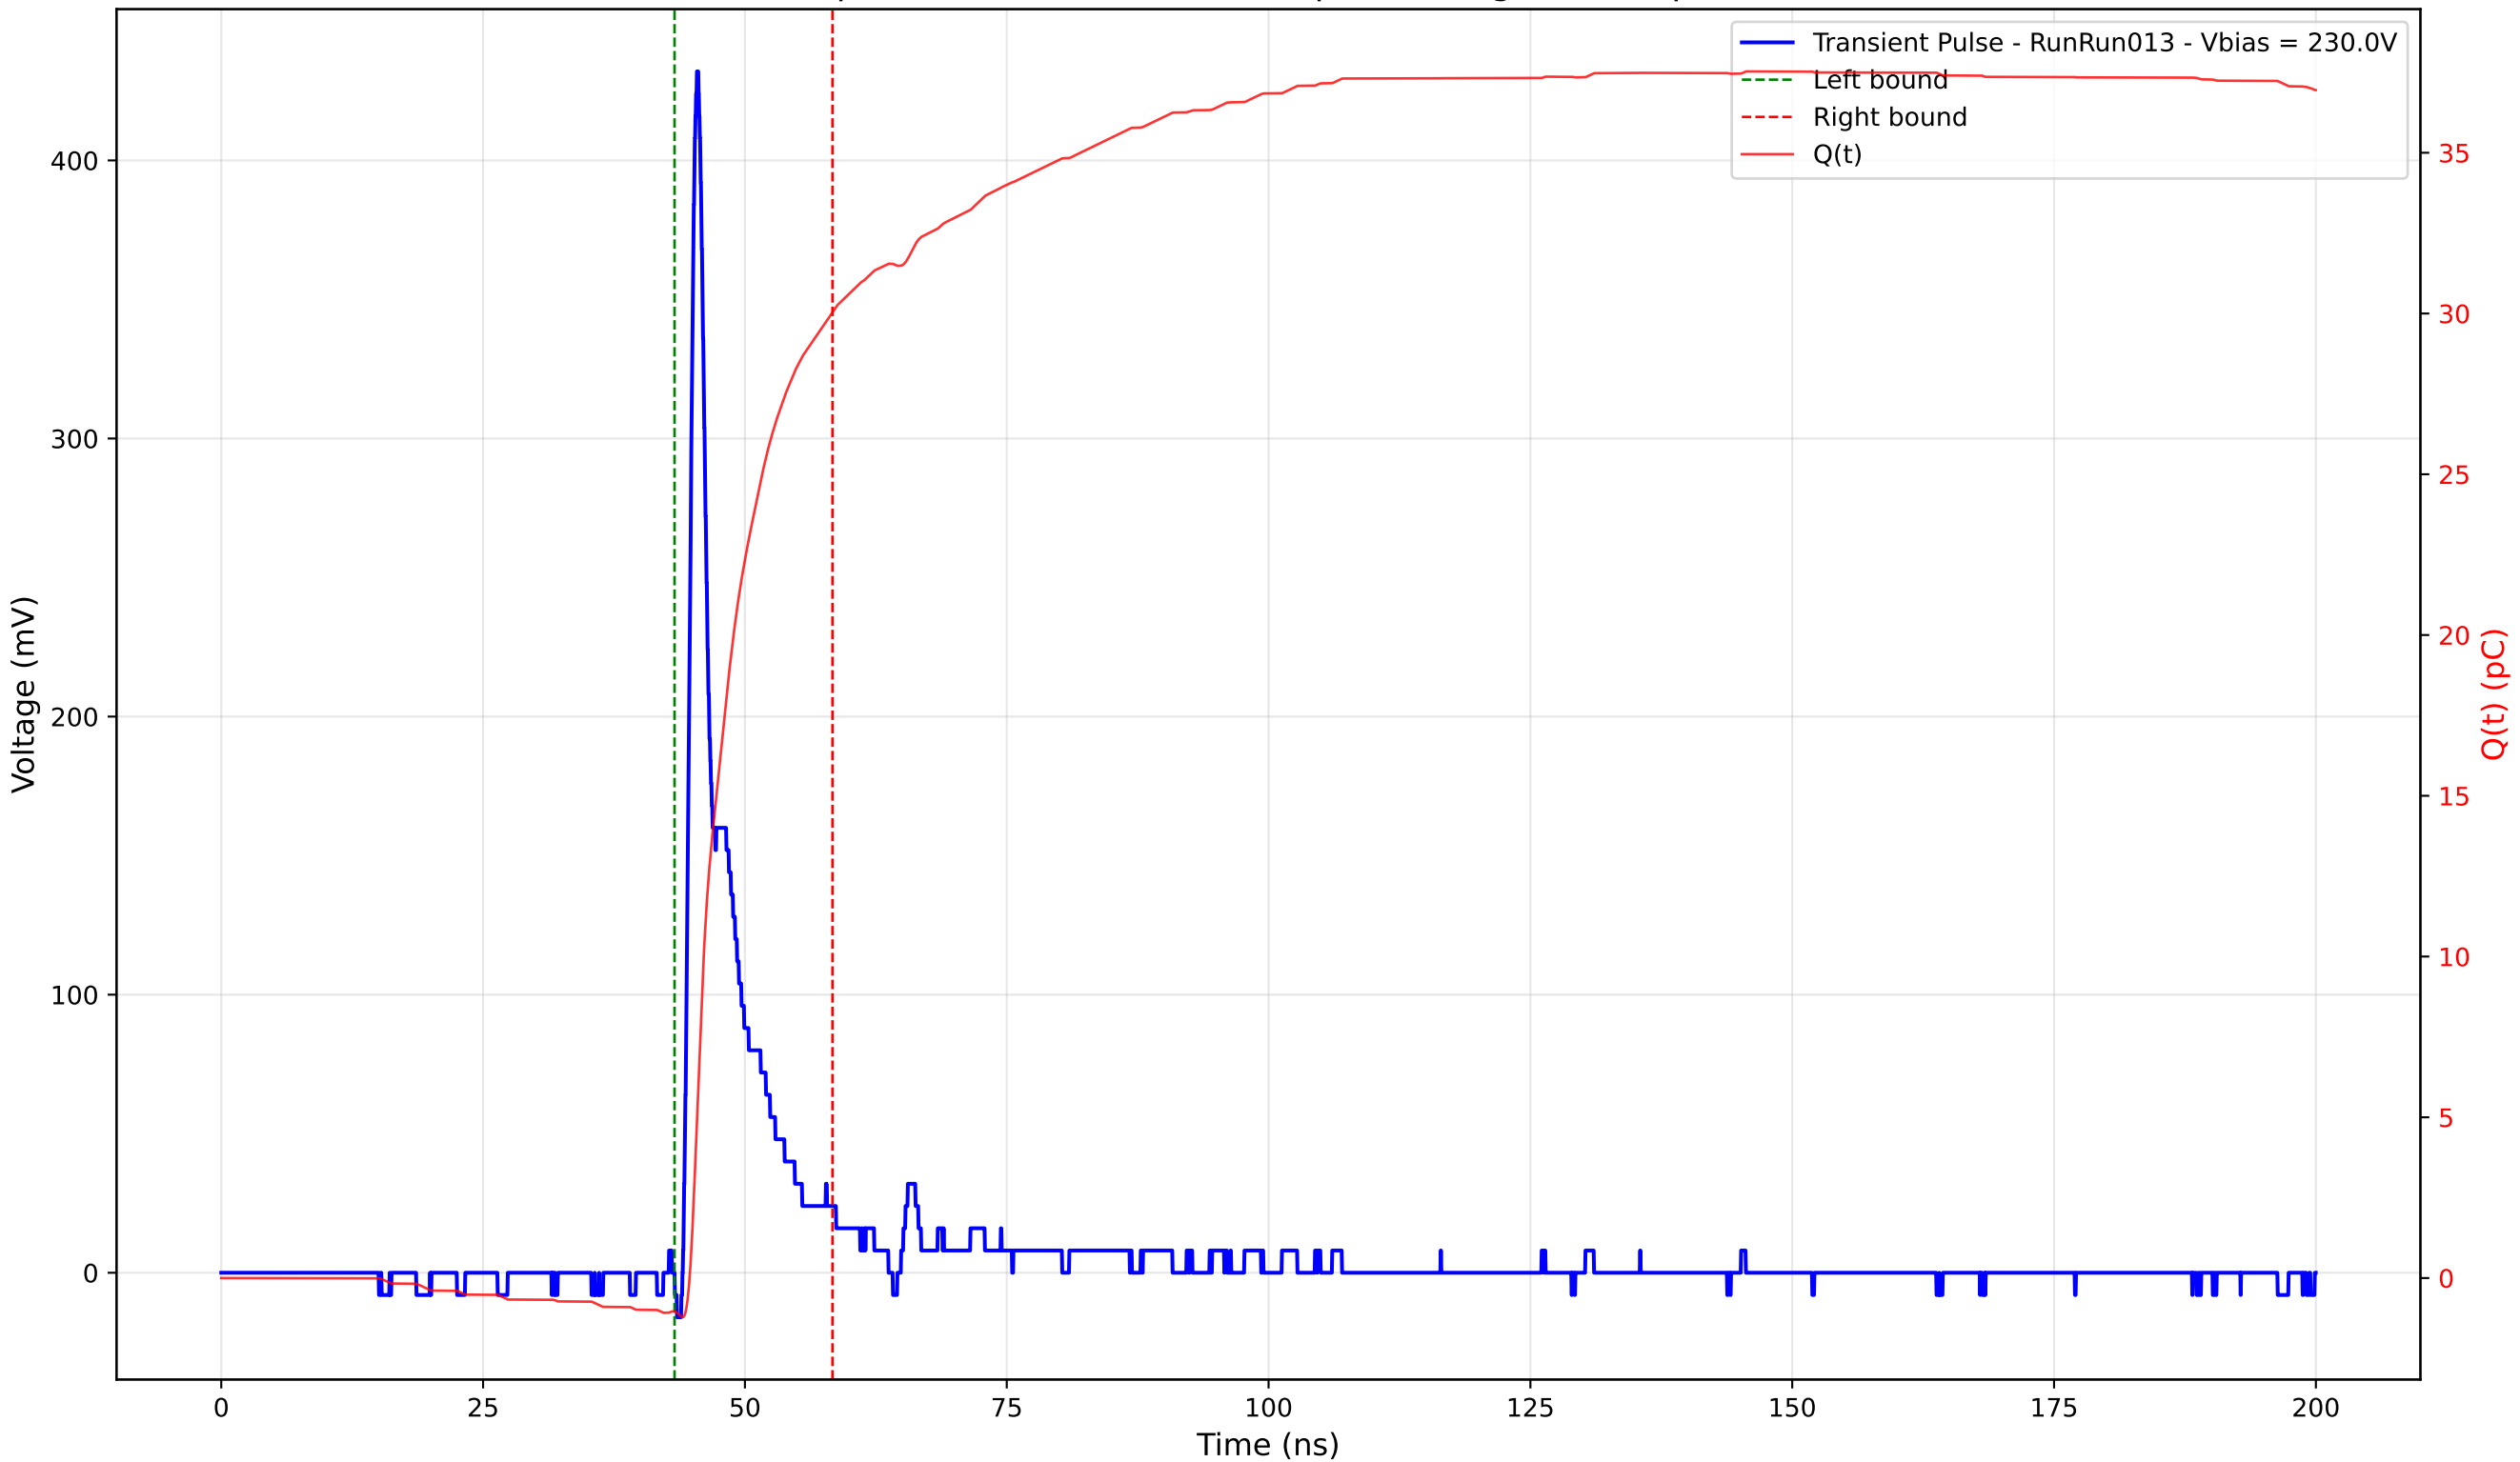


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 35.60 pC - Rise Time: 0.89 ns

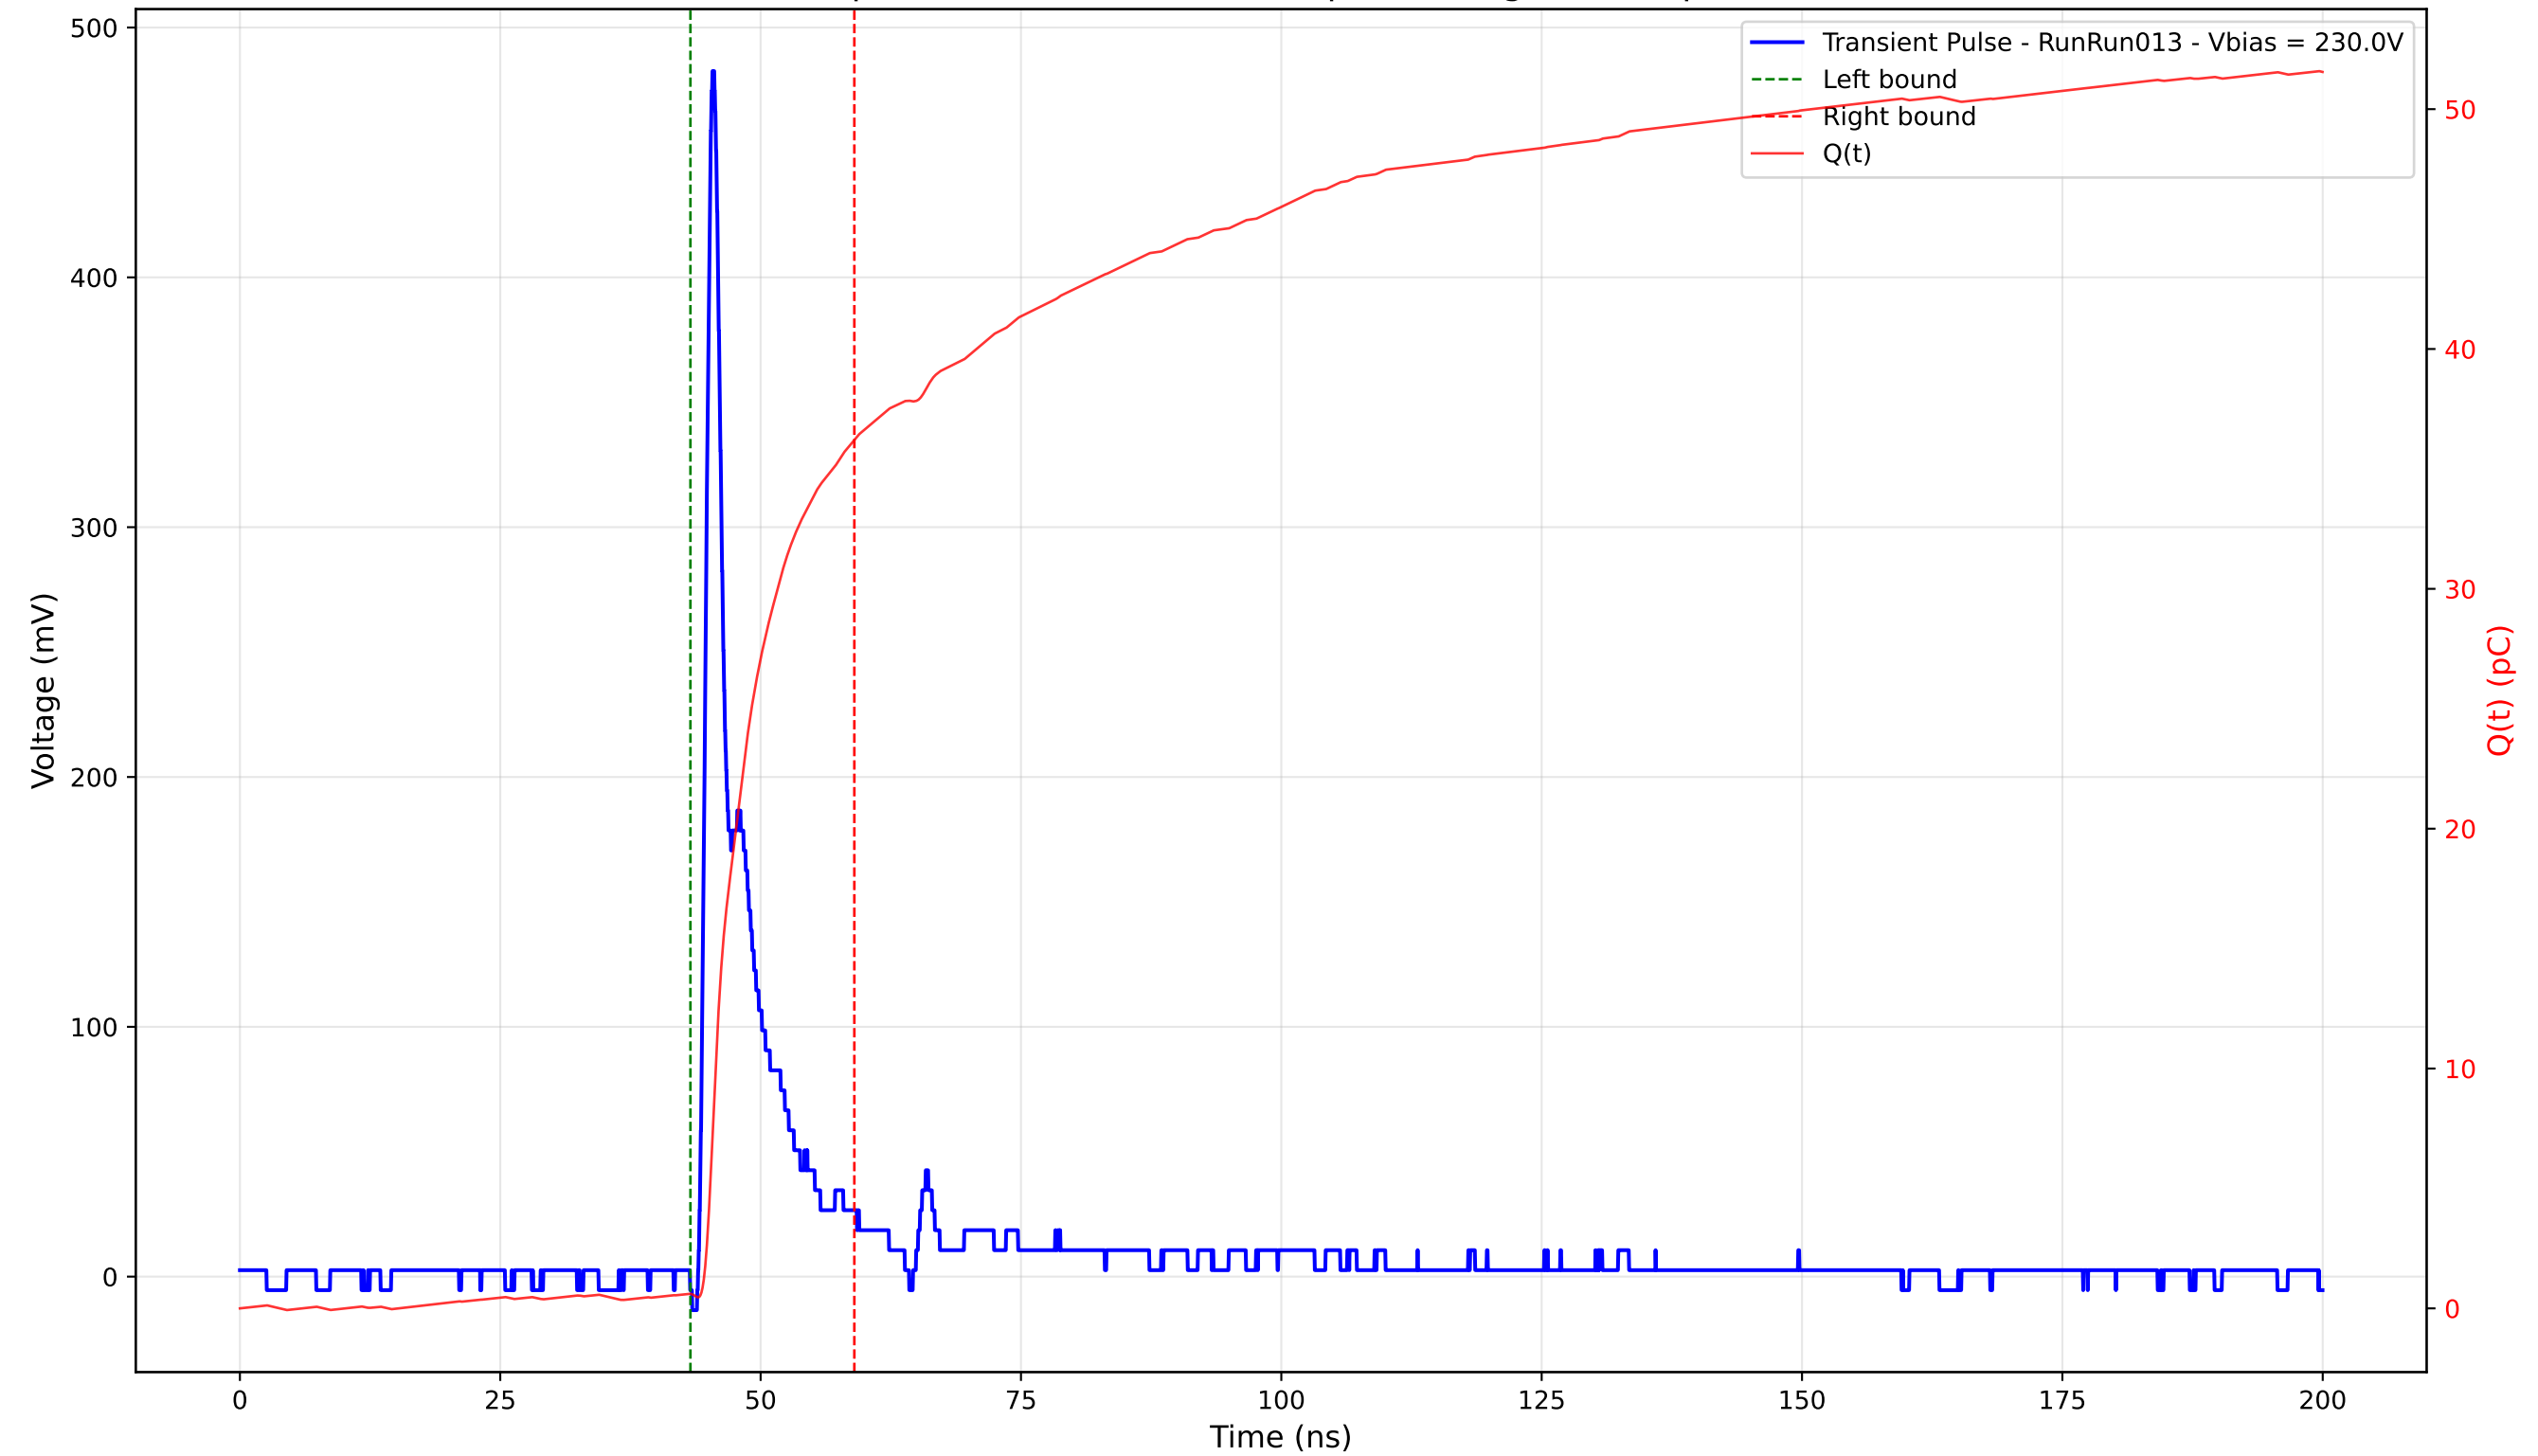


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 37.36 pC - Rise Time: 0.88 ns

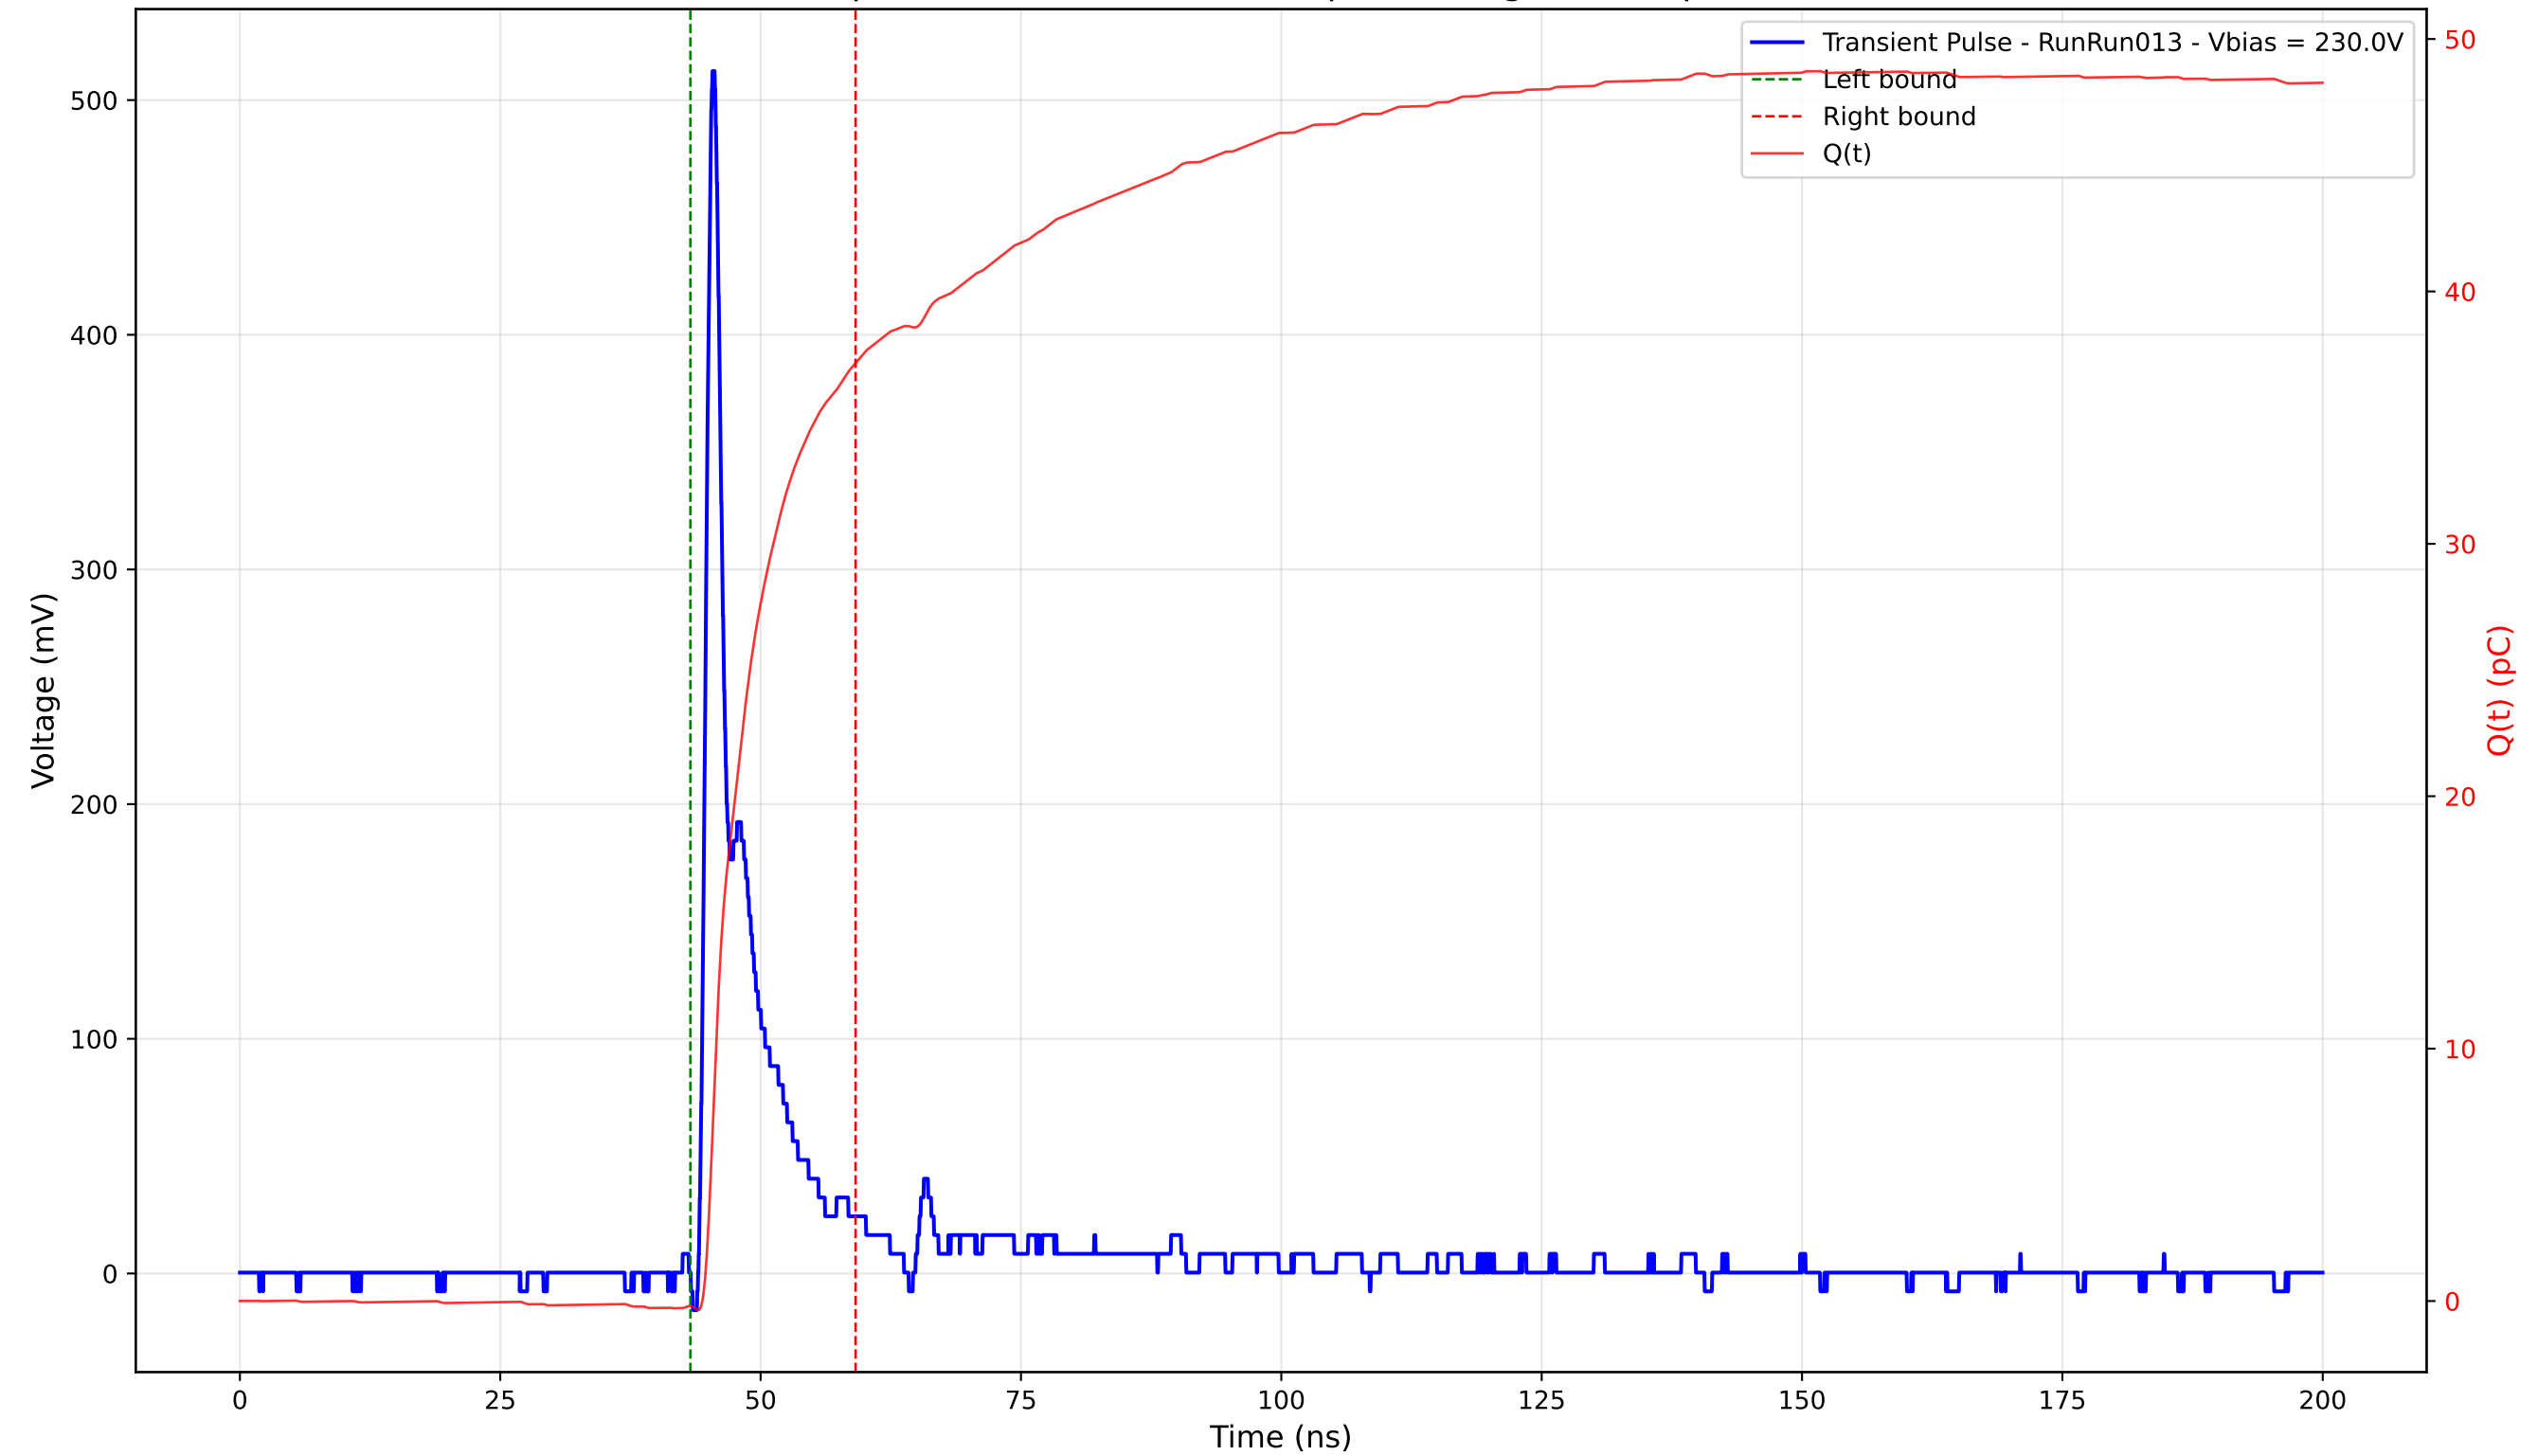


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 37.89 pC - Rise Time: 0.89 ns

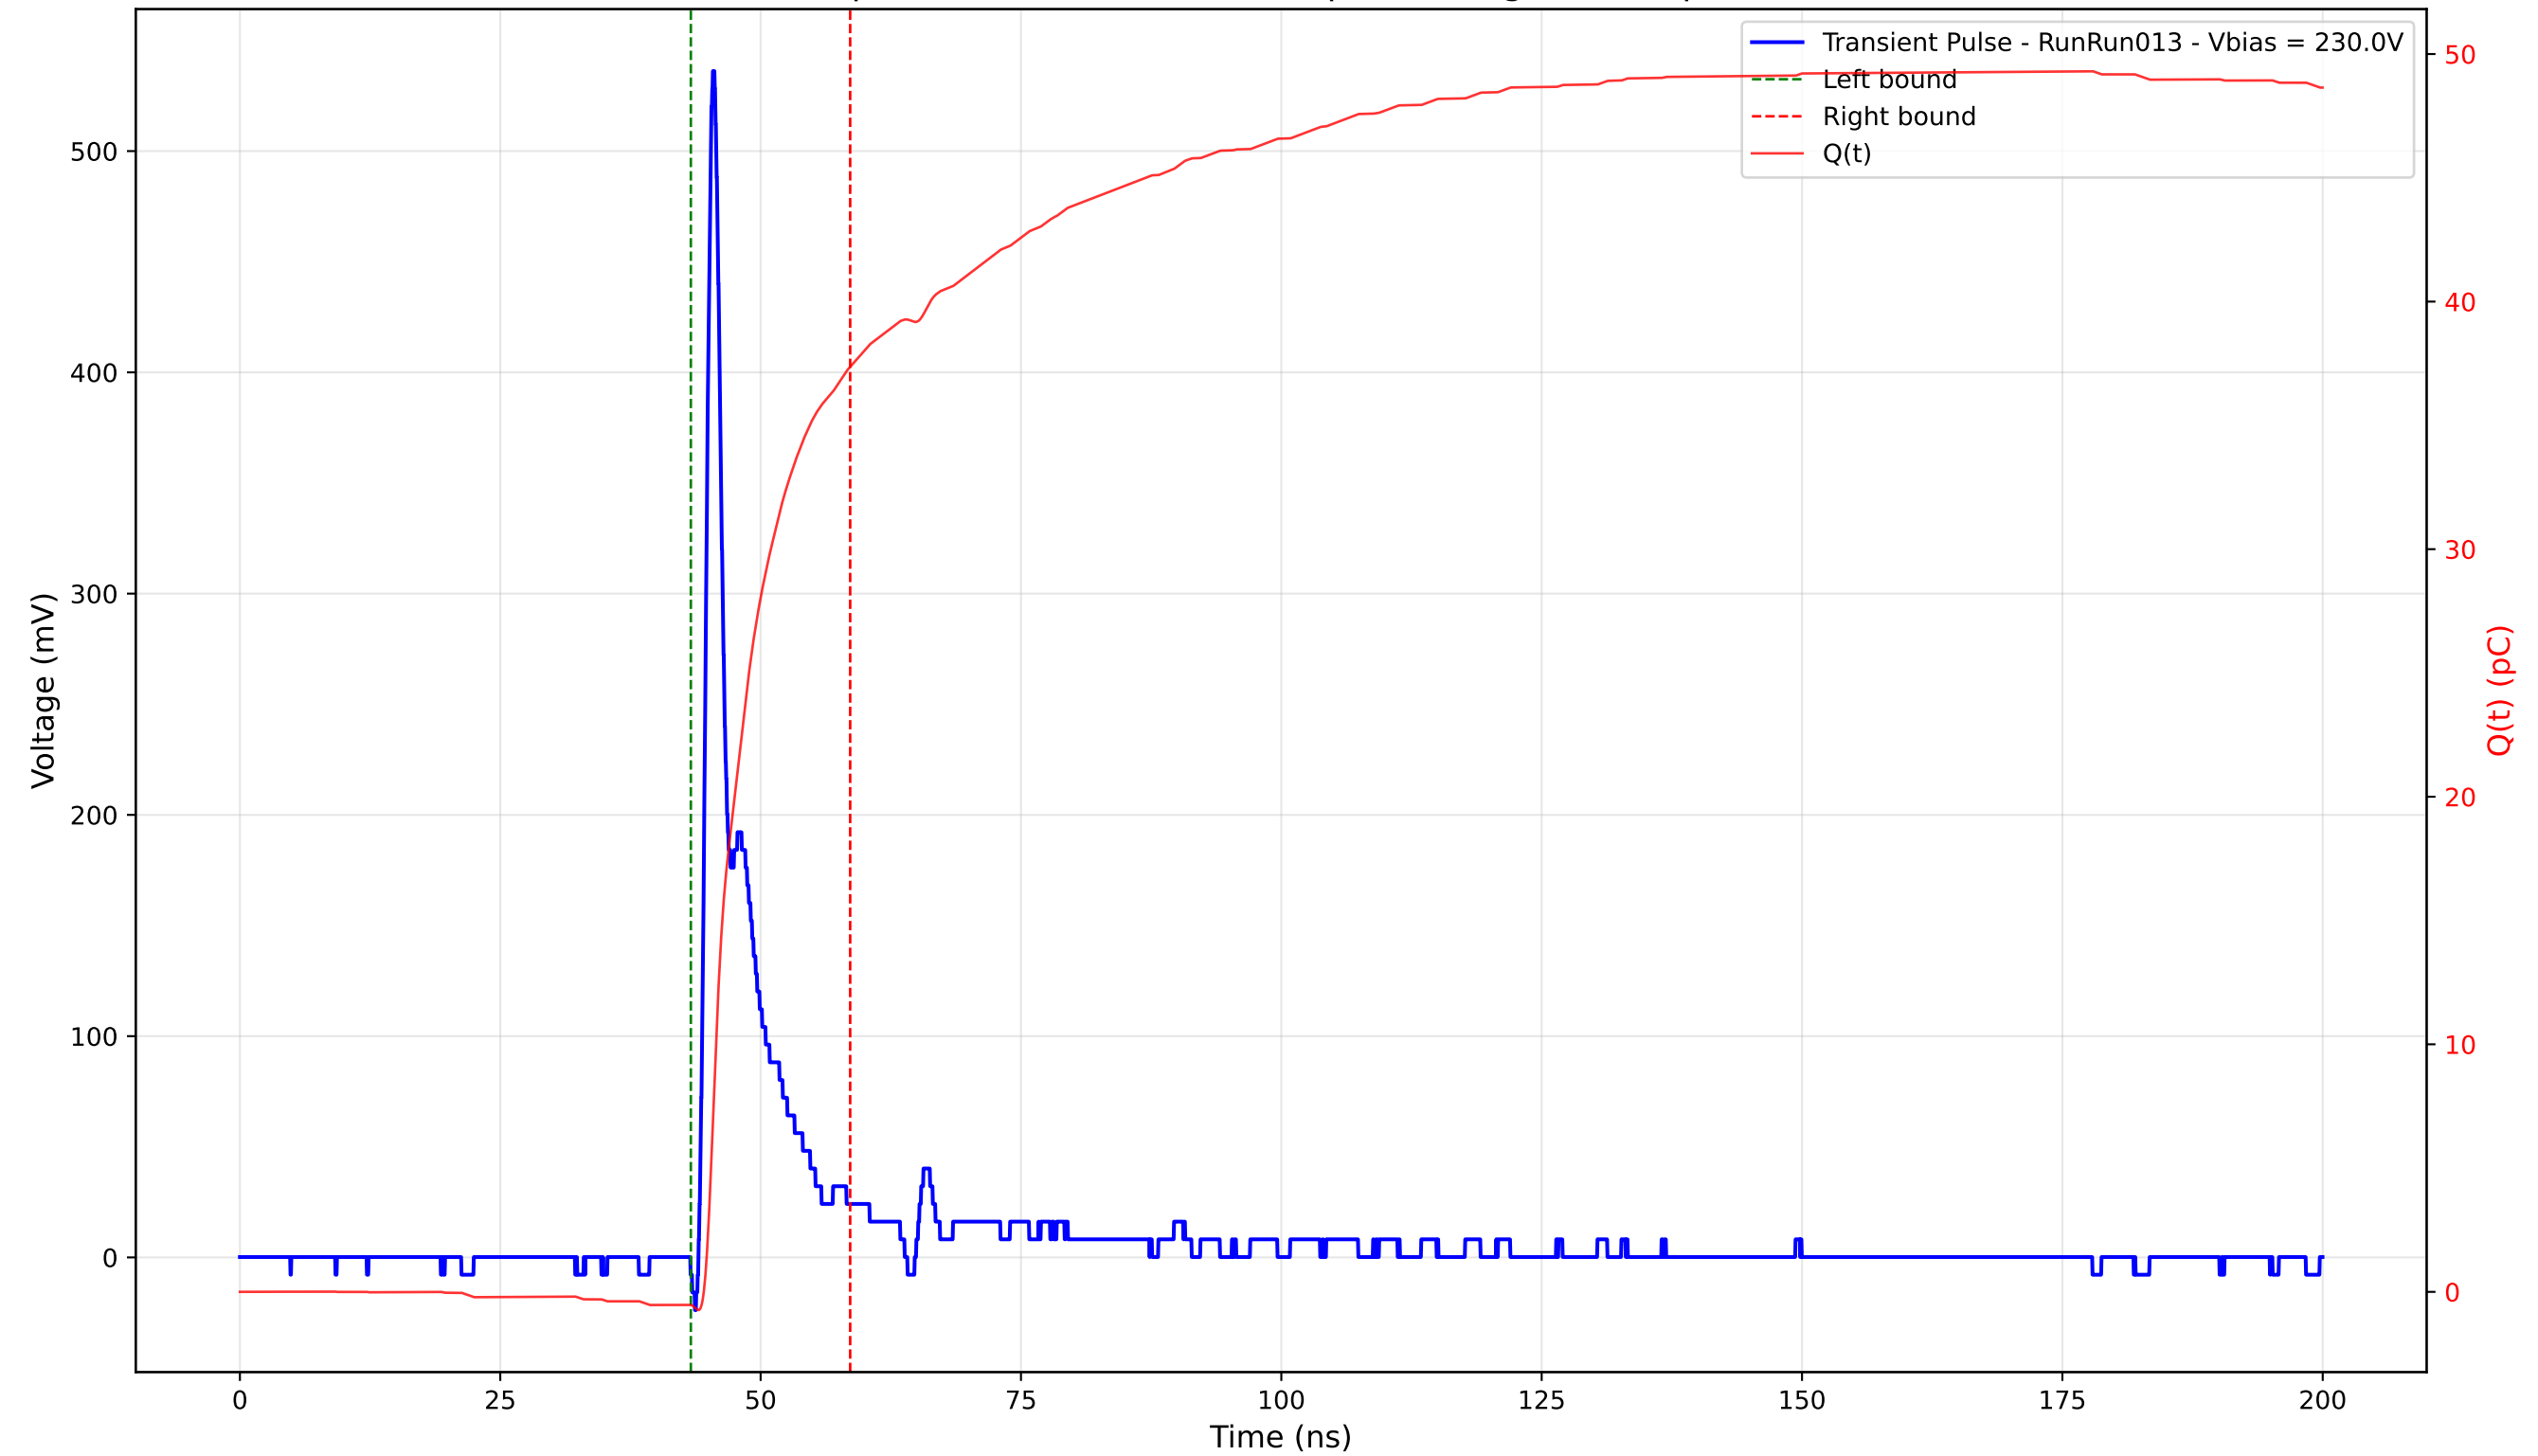


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 38.52 pC - Rise Time: 0.91 ns

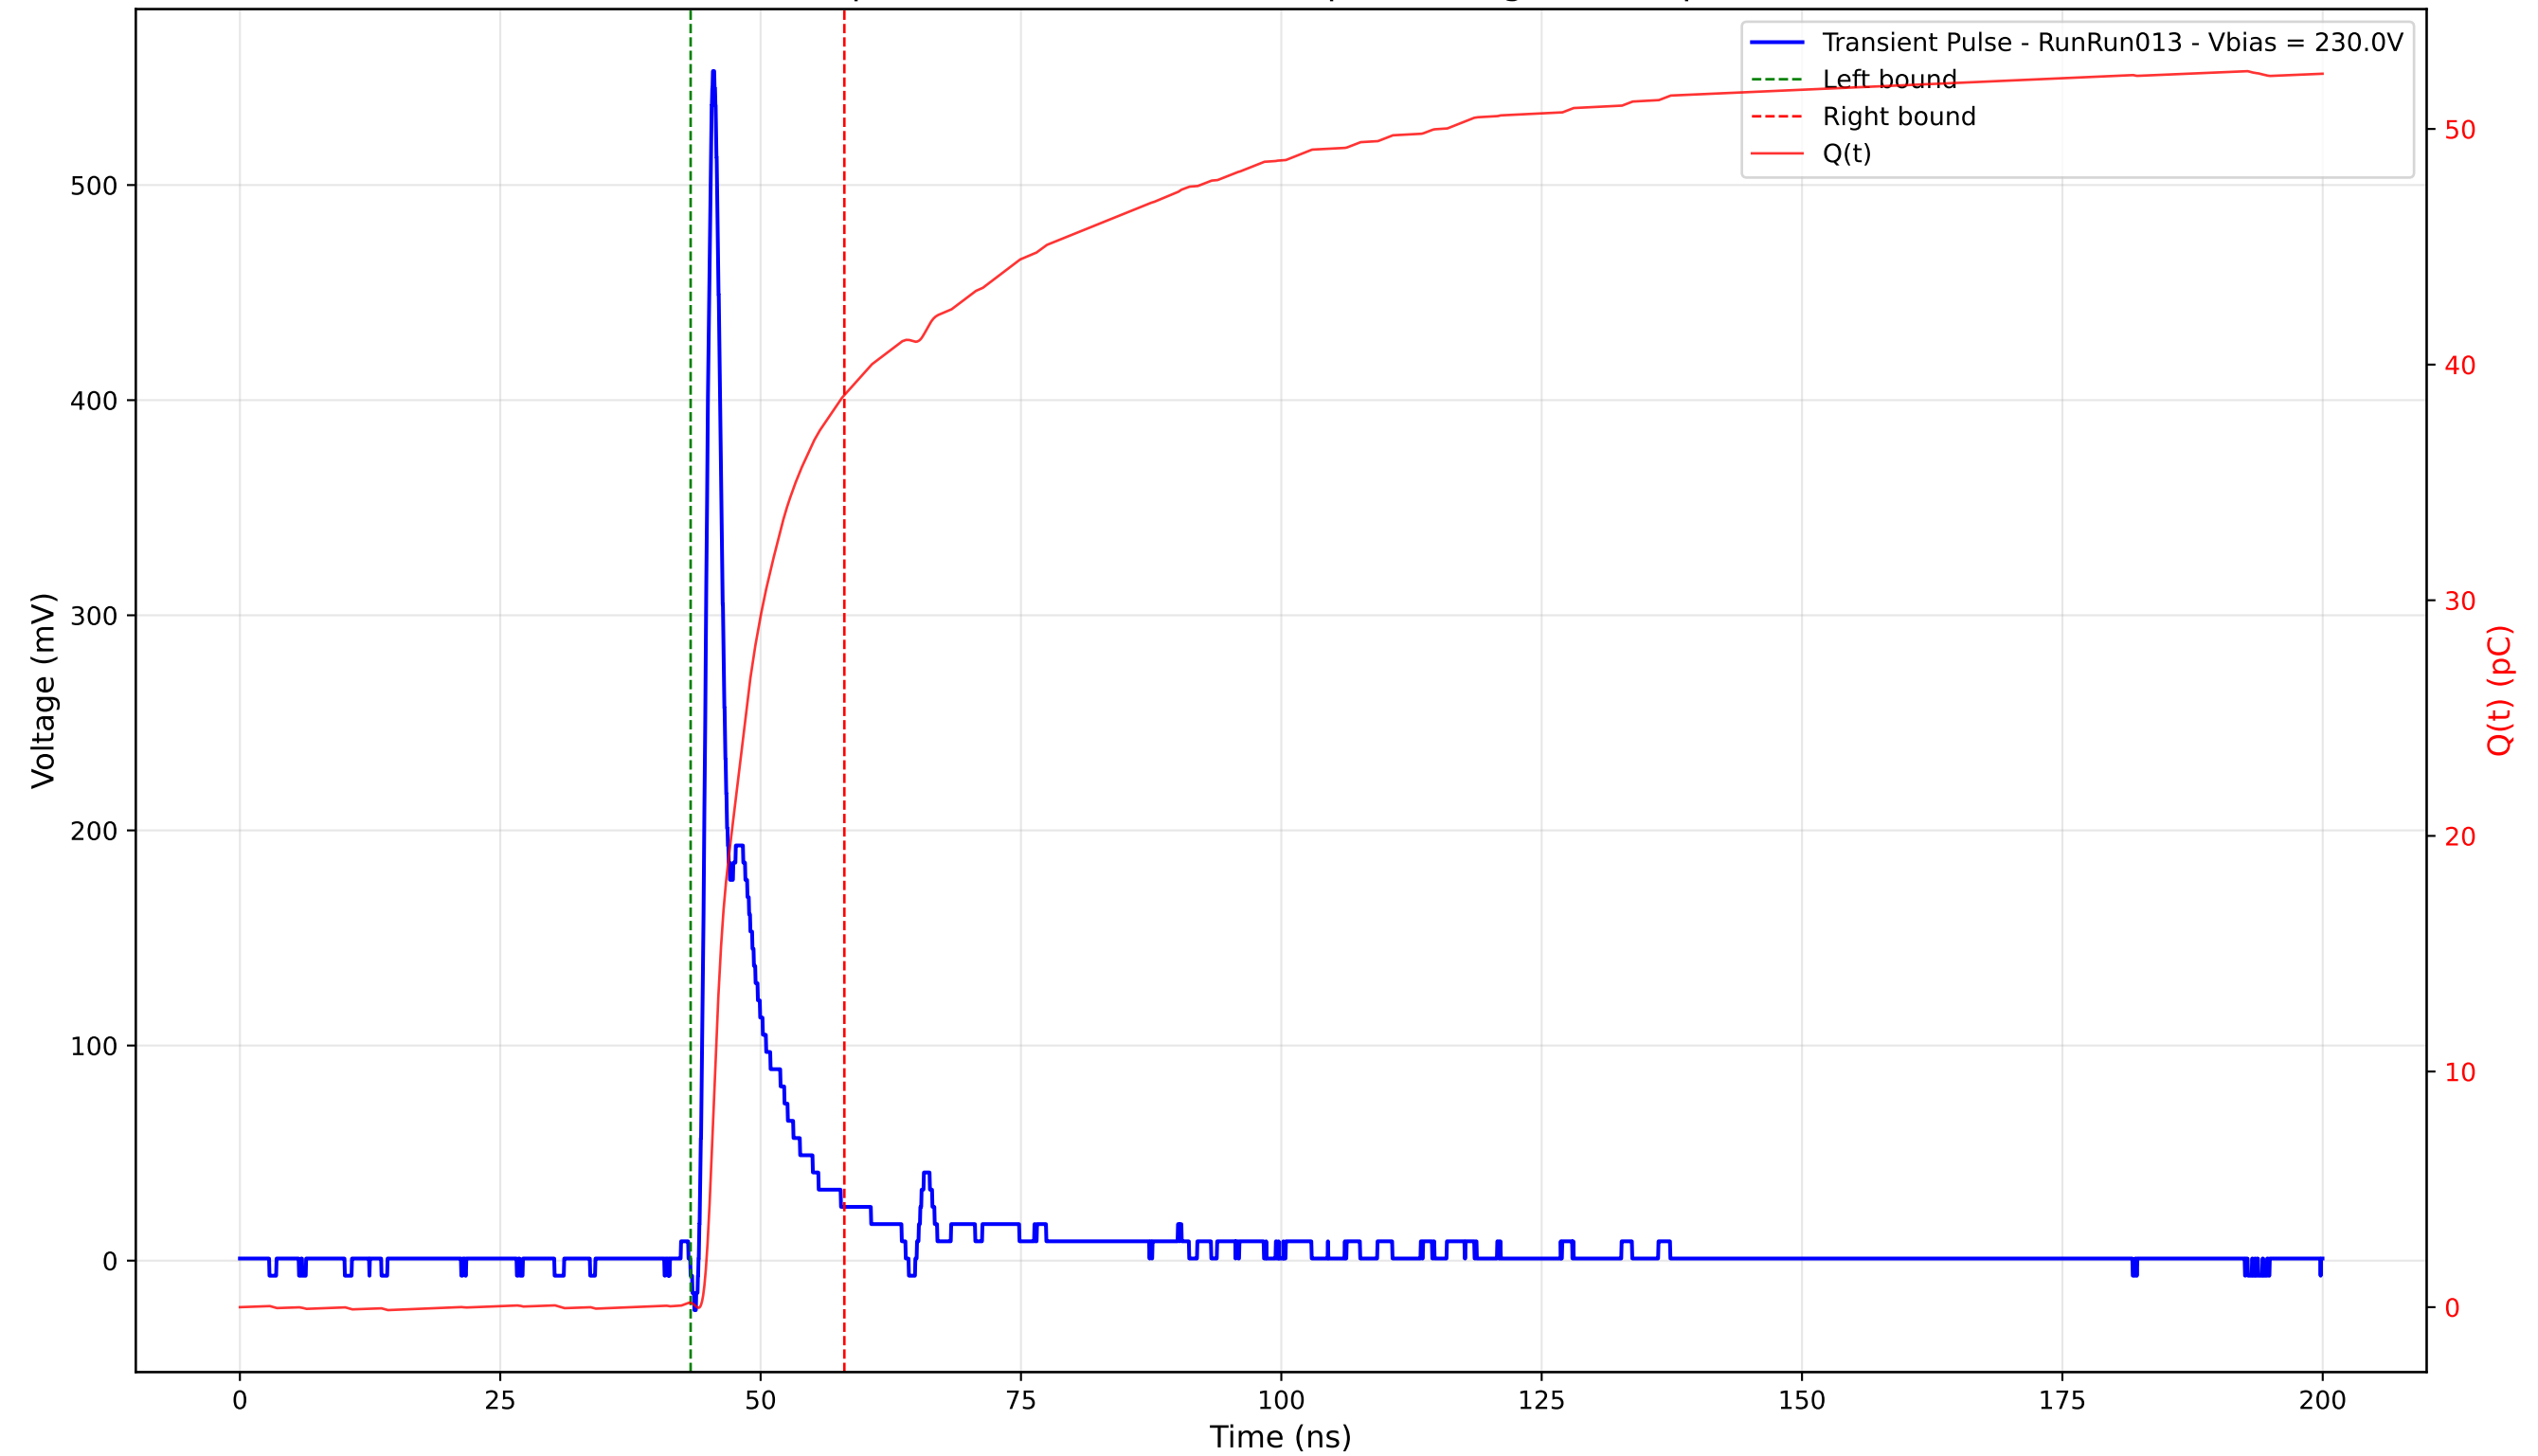


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 39.78 pC - Rise Time: 0.90 ns

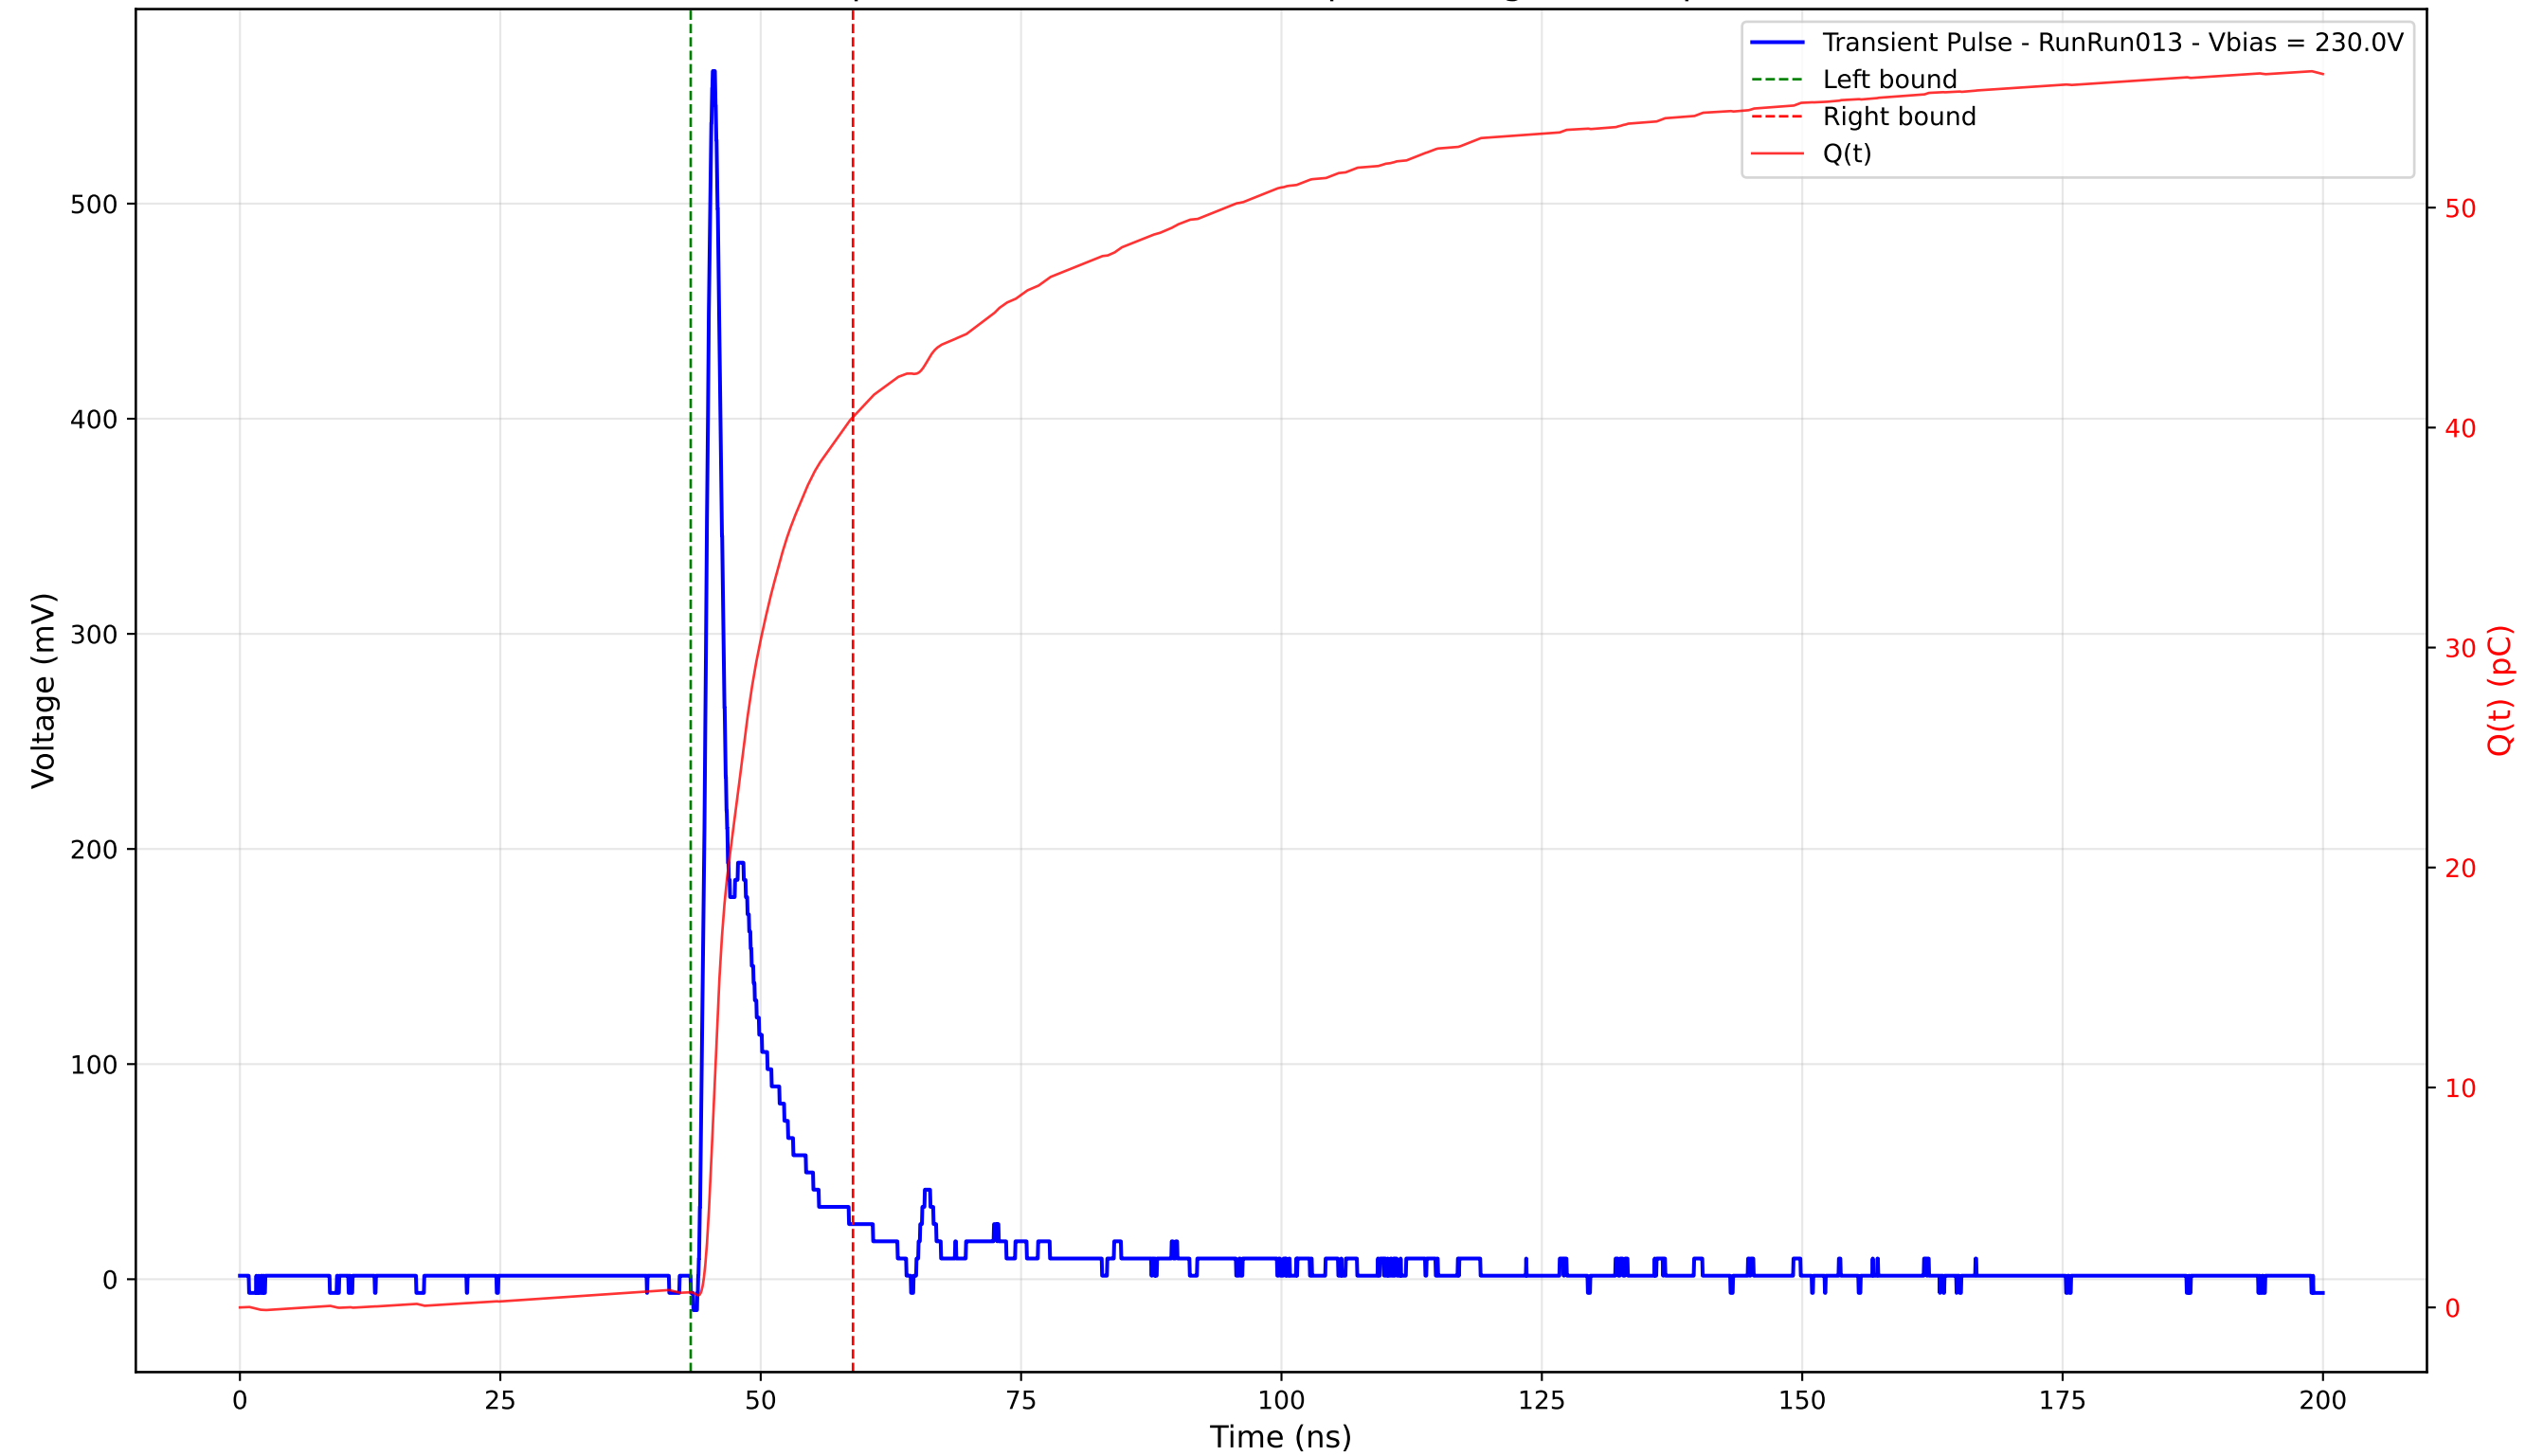


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 38.41 pC - Rise Time: 0.94 ns

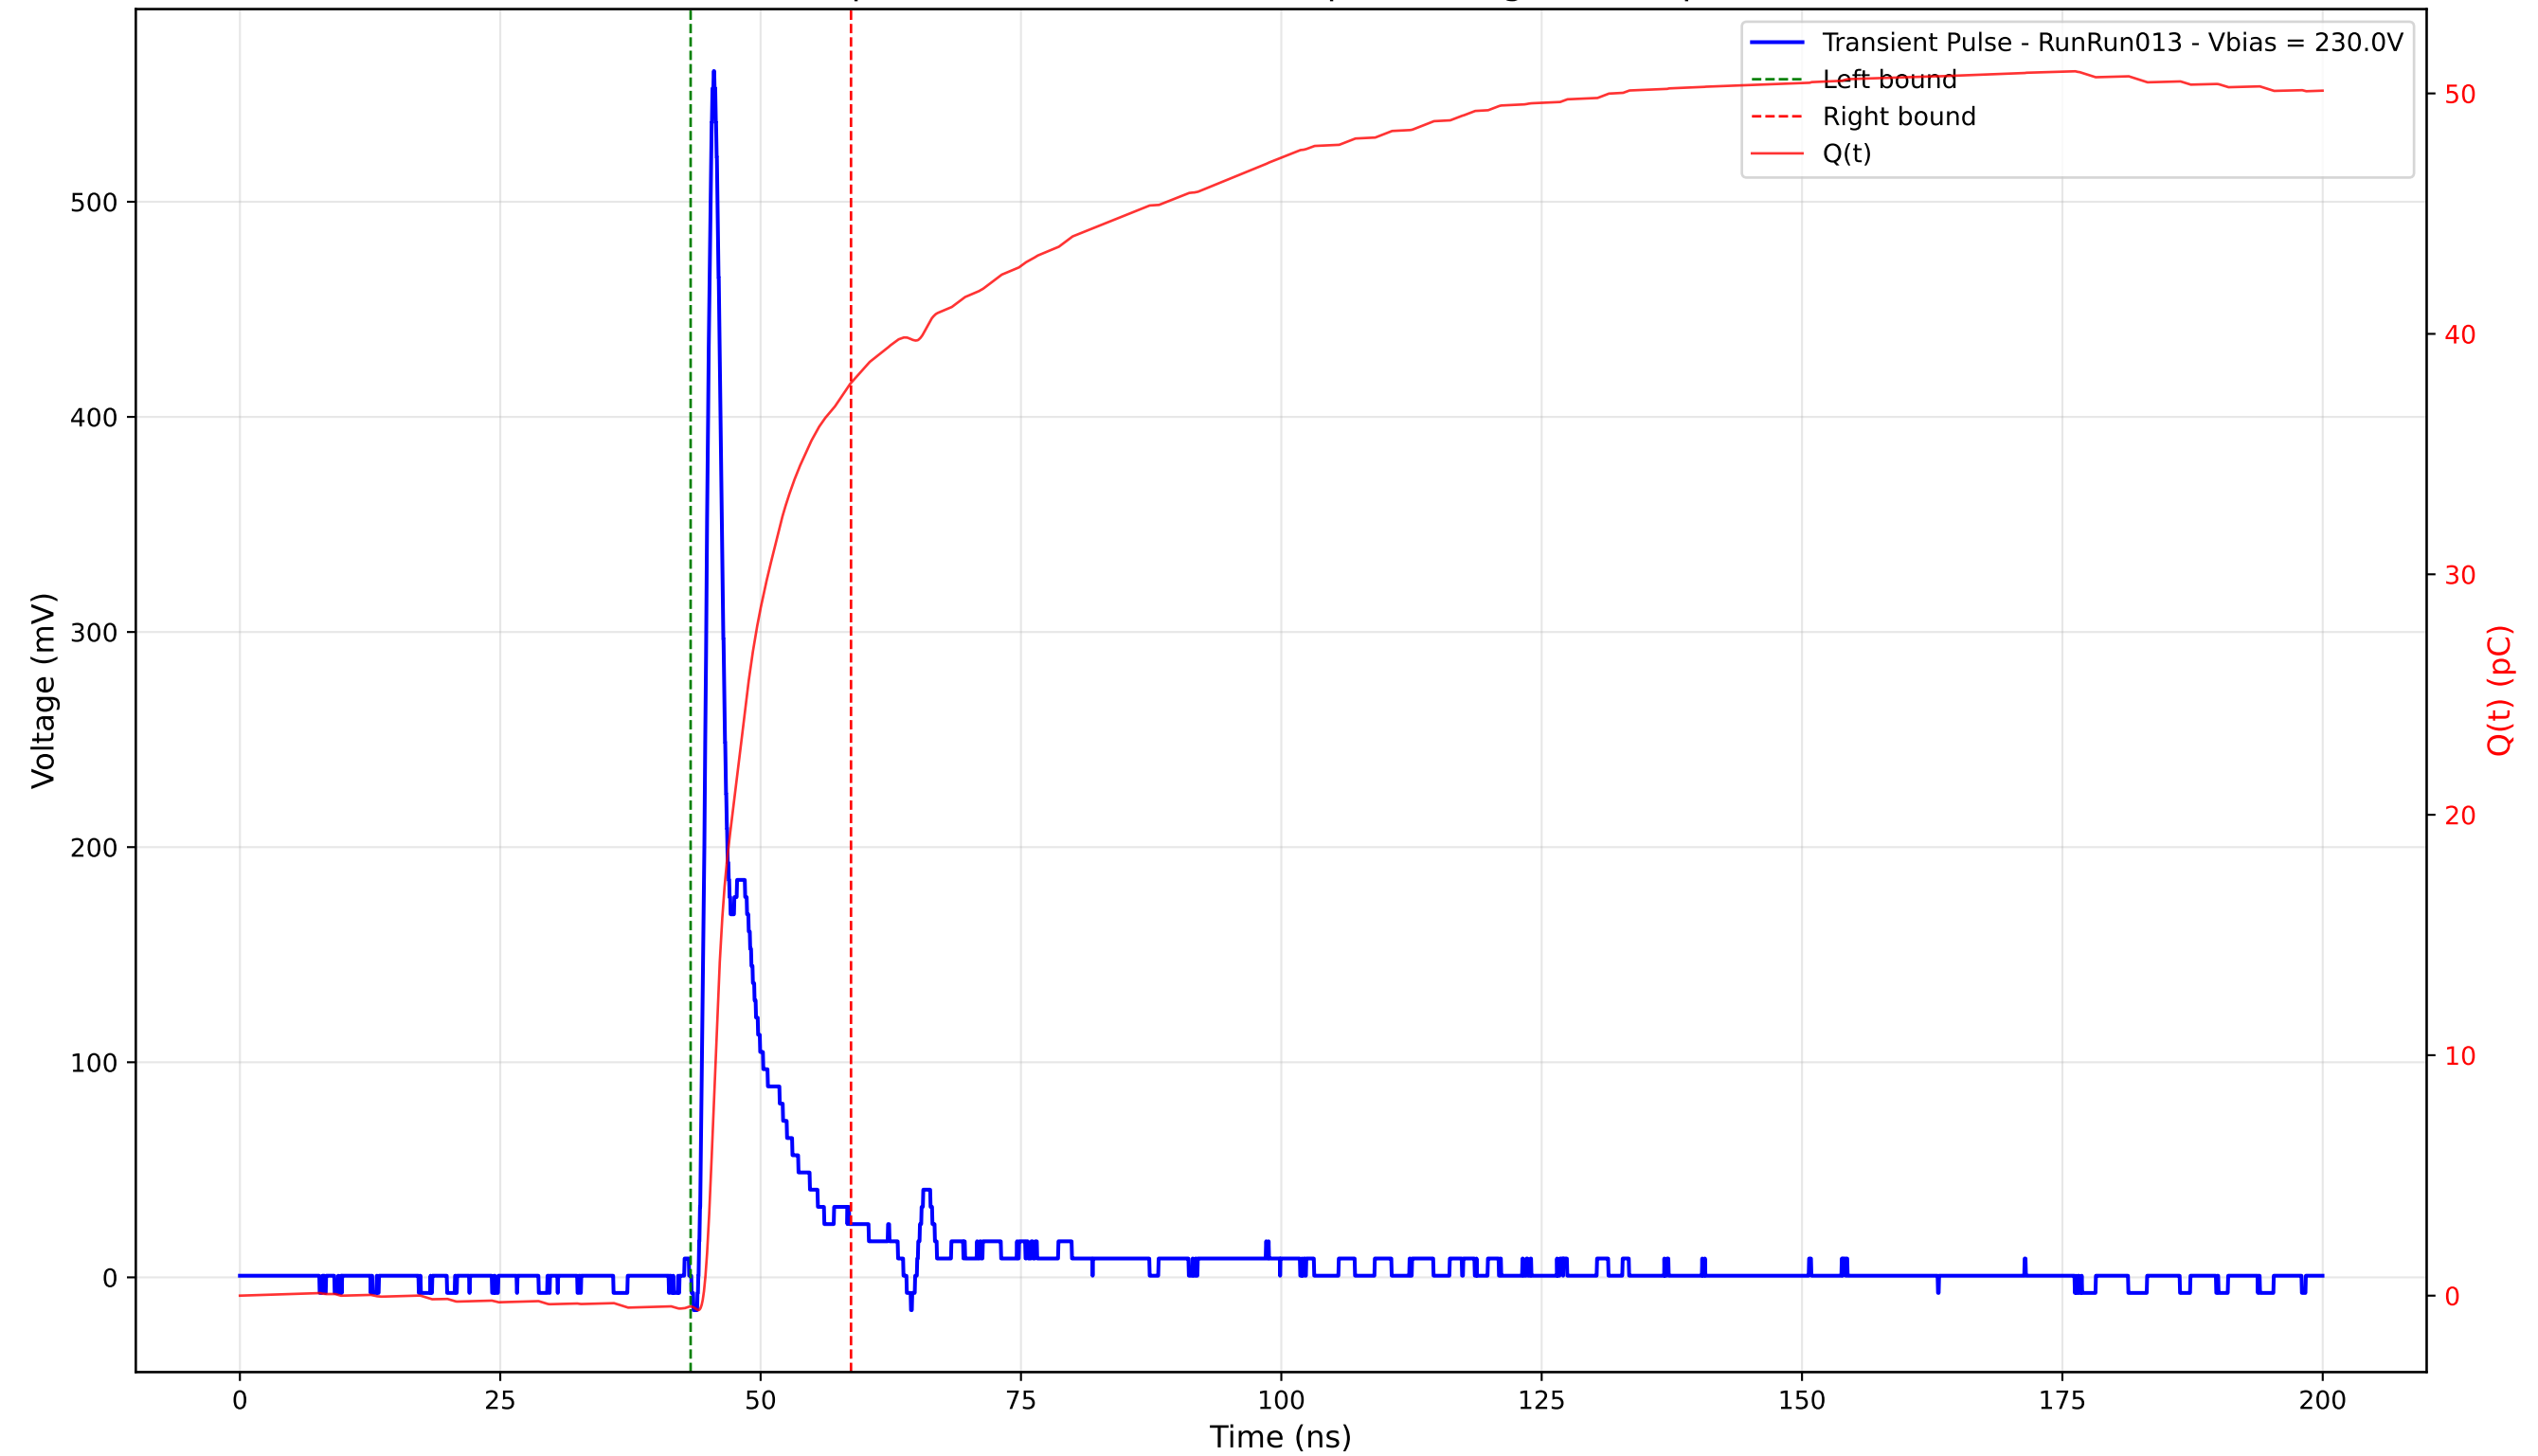


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 38.93 pC - Rise Time: 0.92 ns

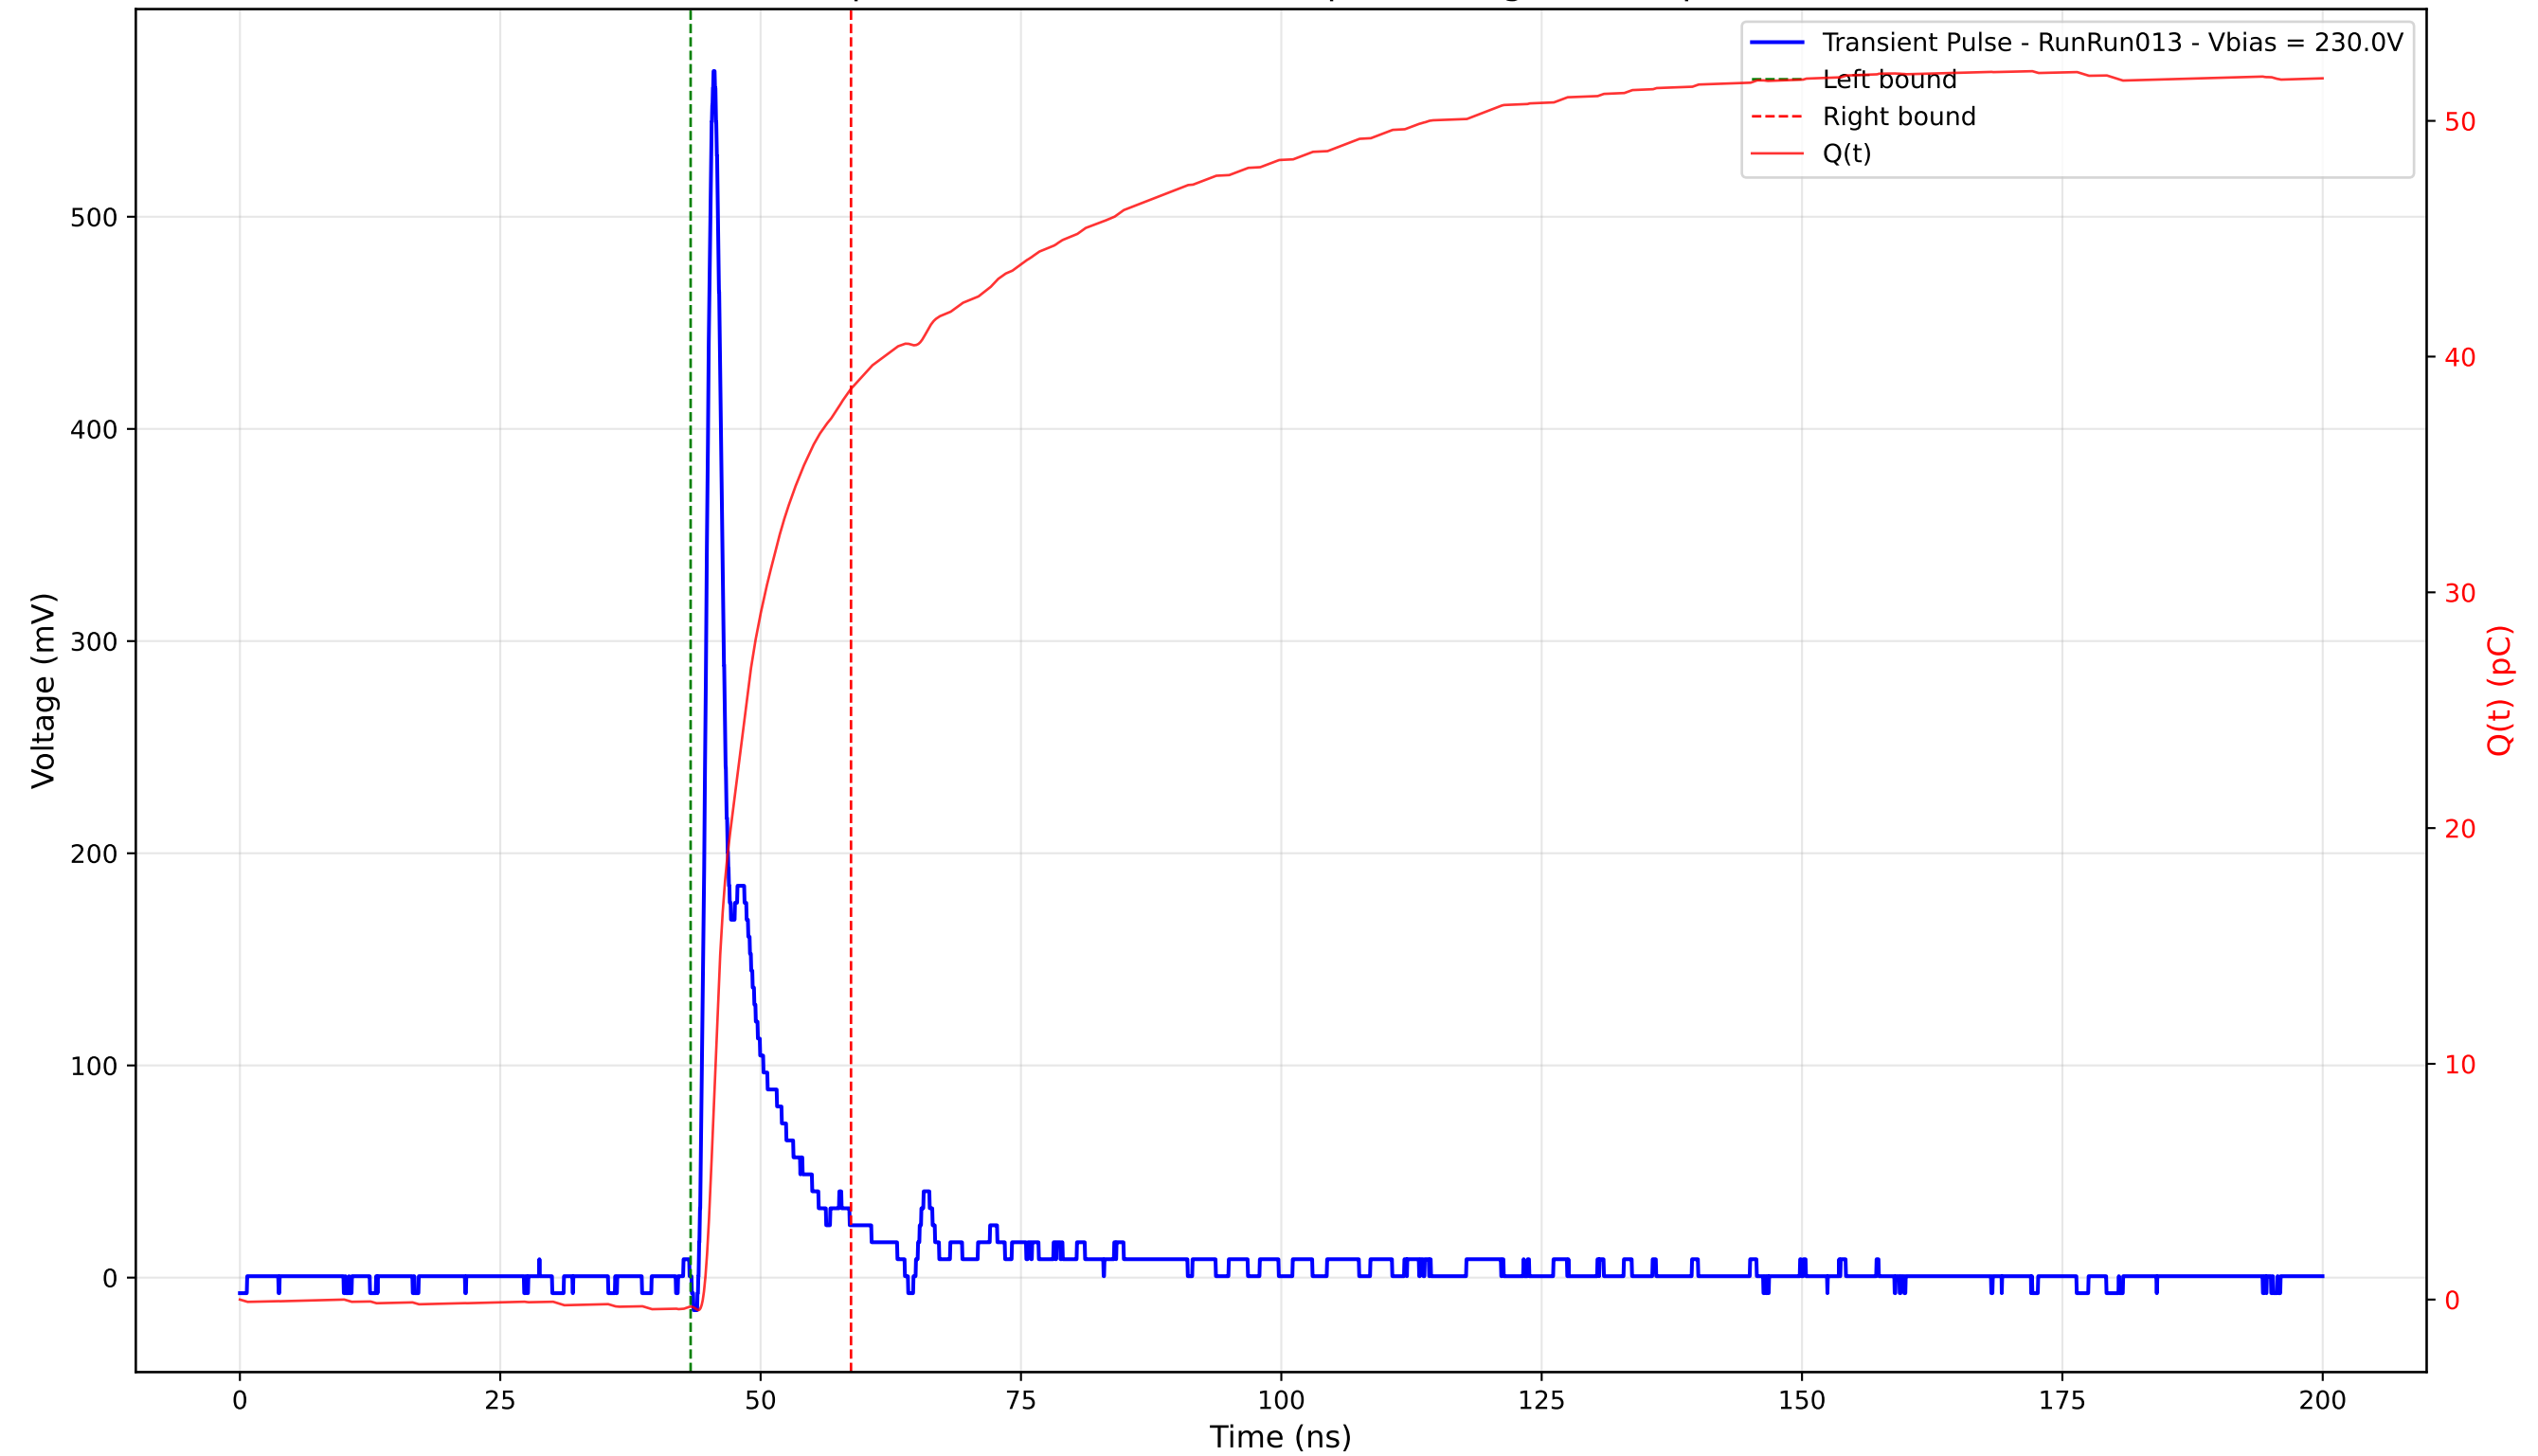


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 37.21 pC - Rise Time: 0.94 ns

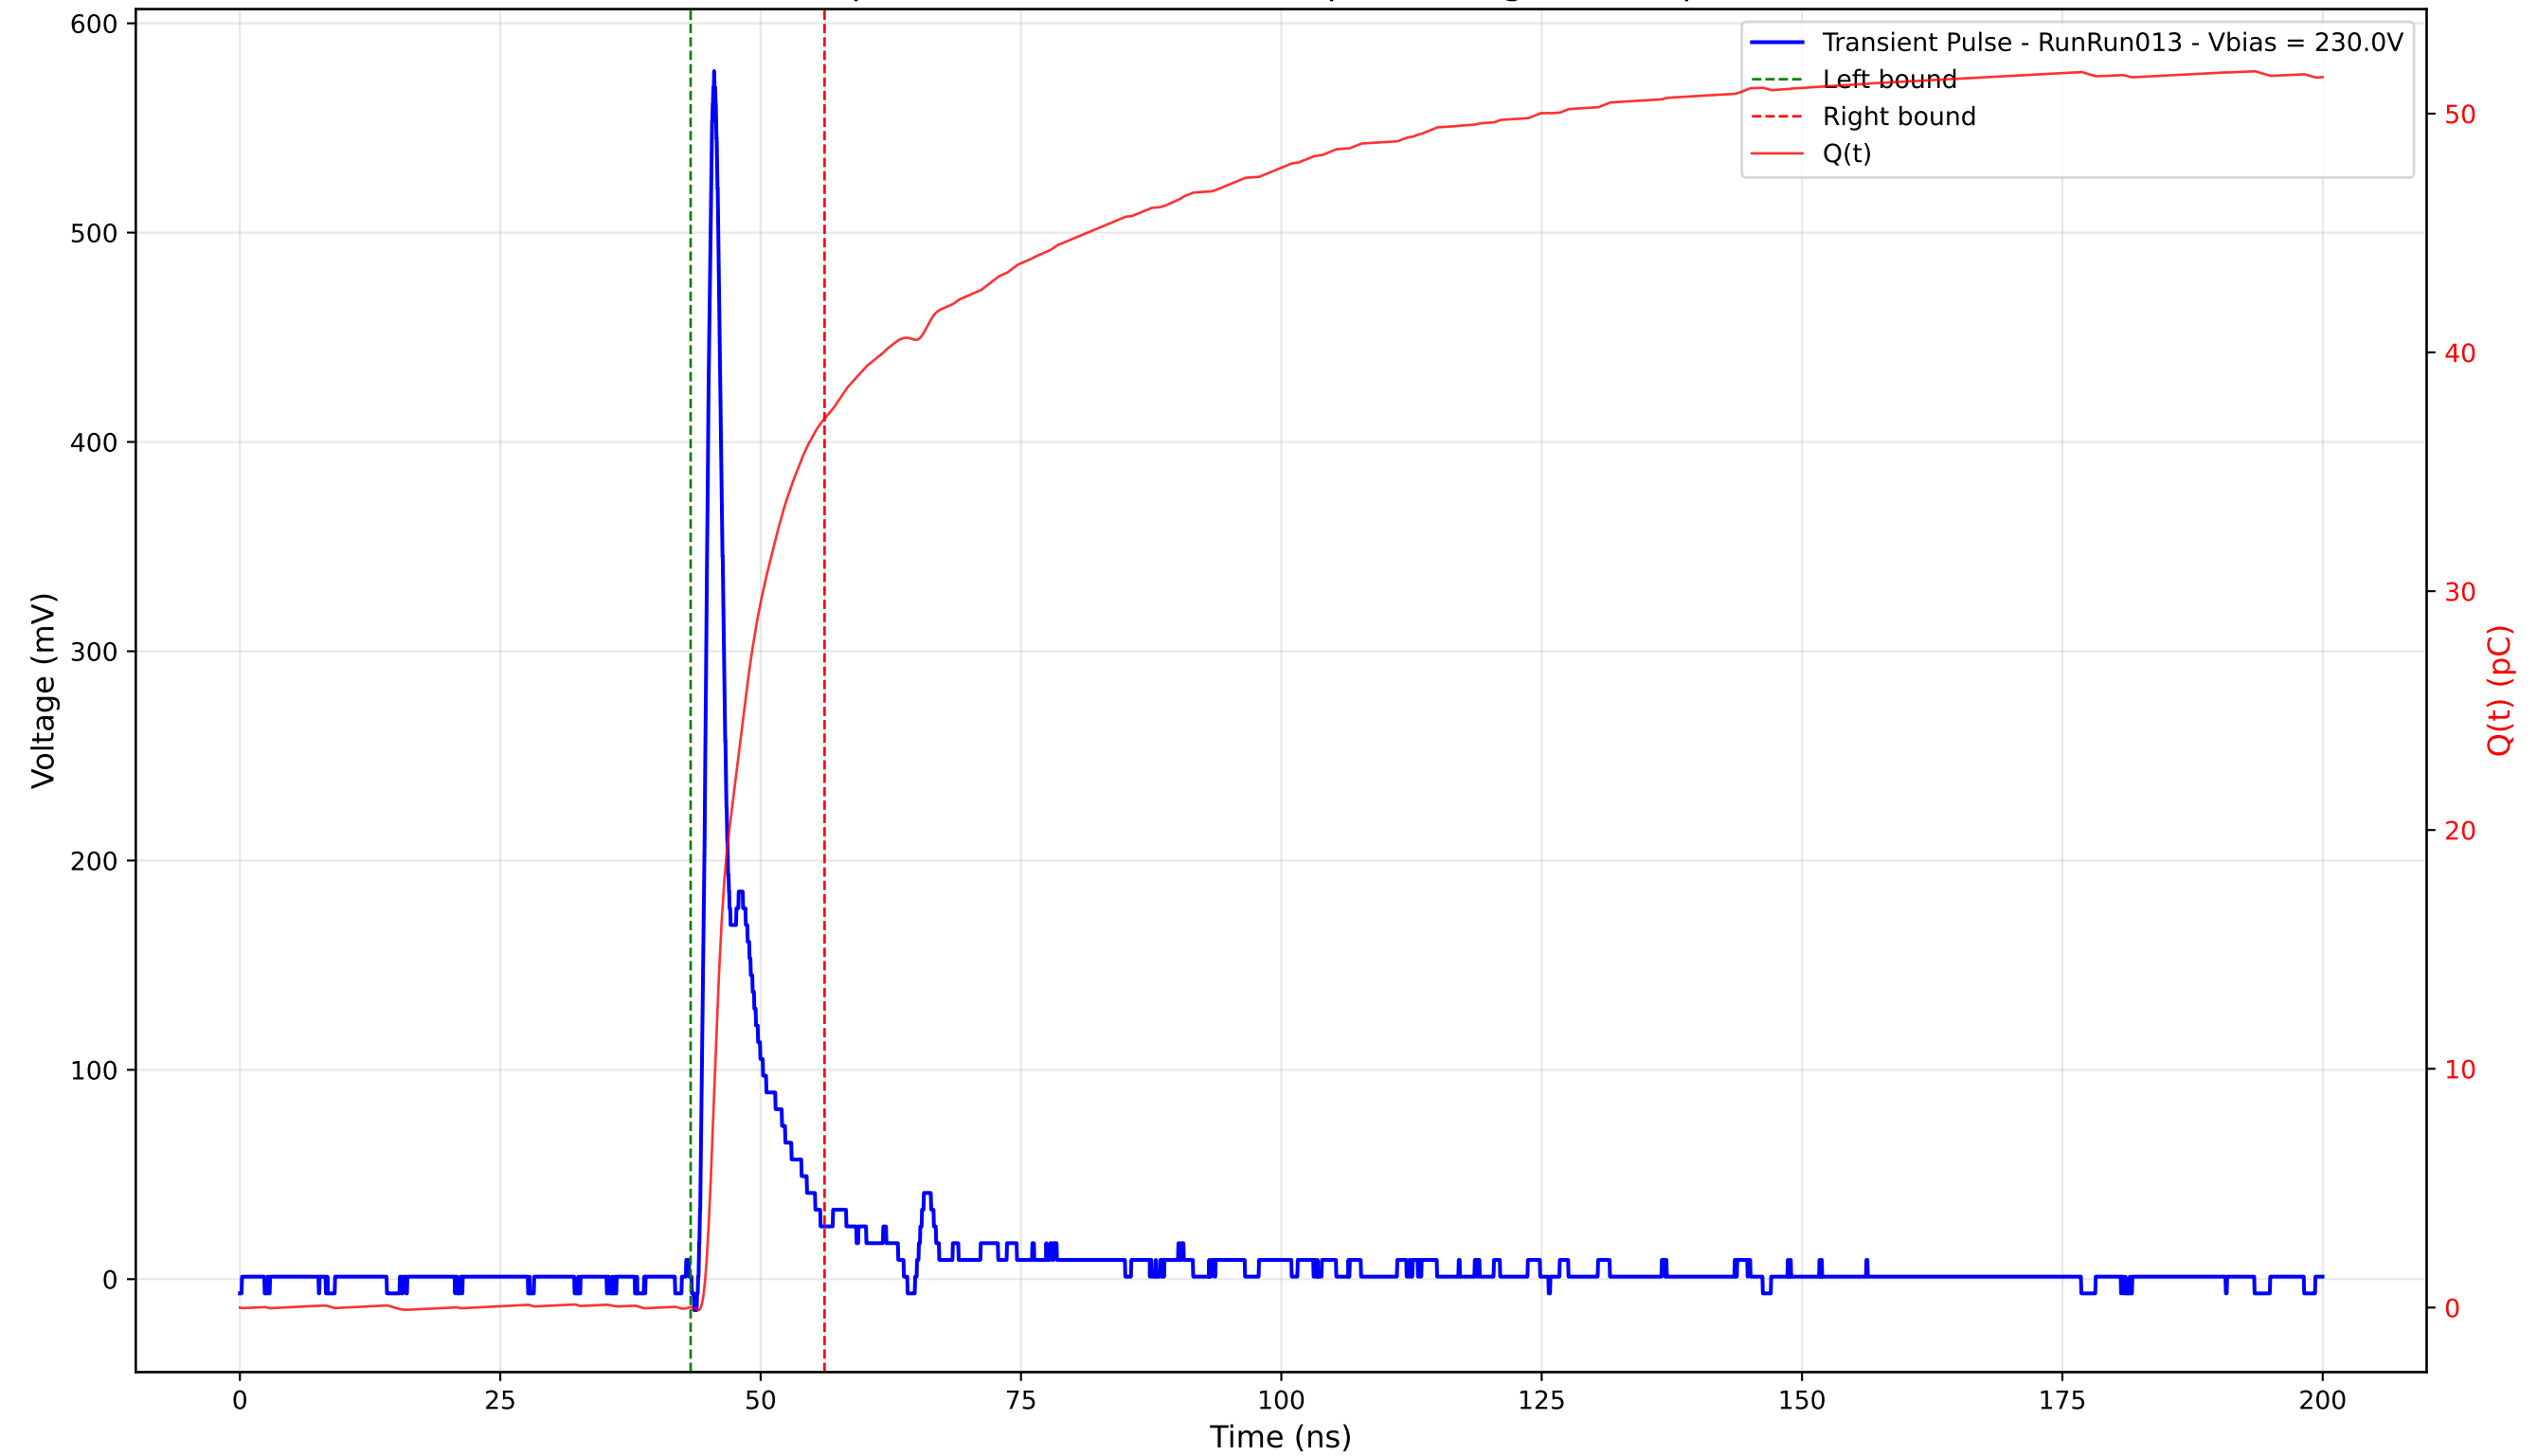


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 38.69 pC - Rise Time: 0.94 ns

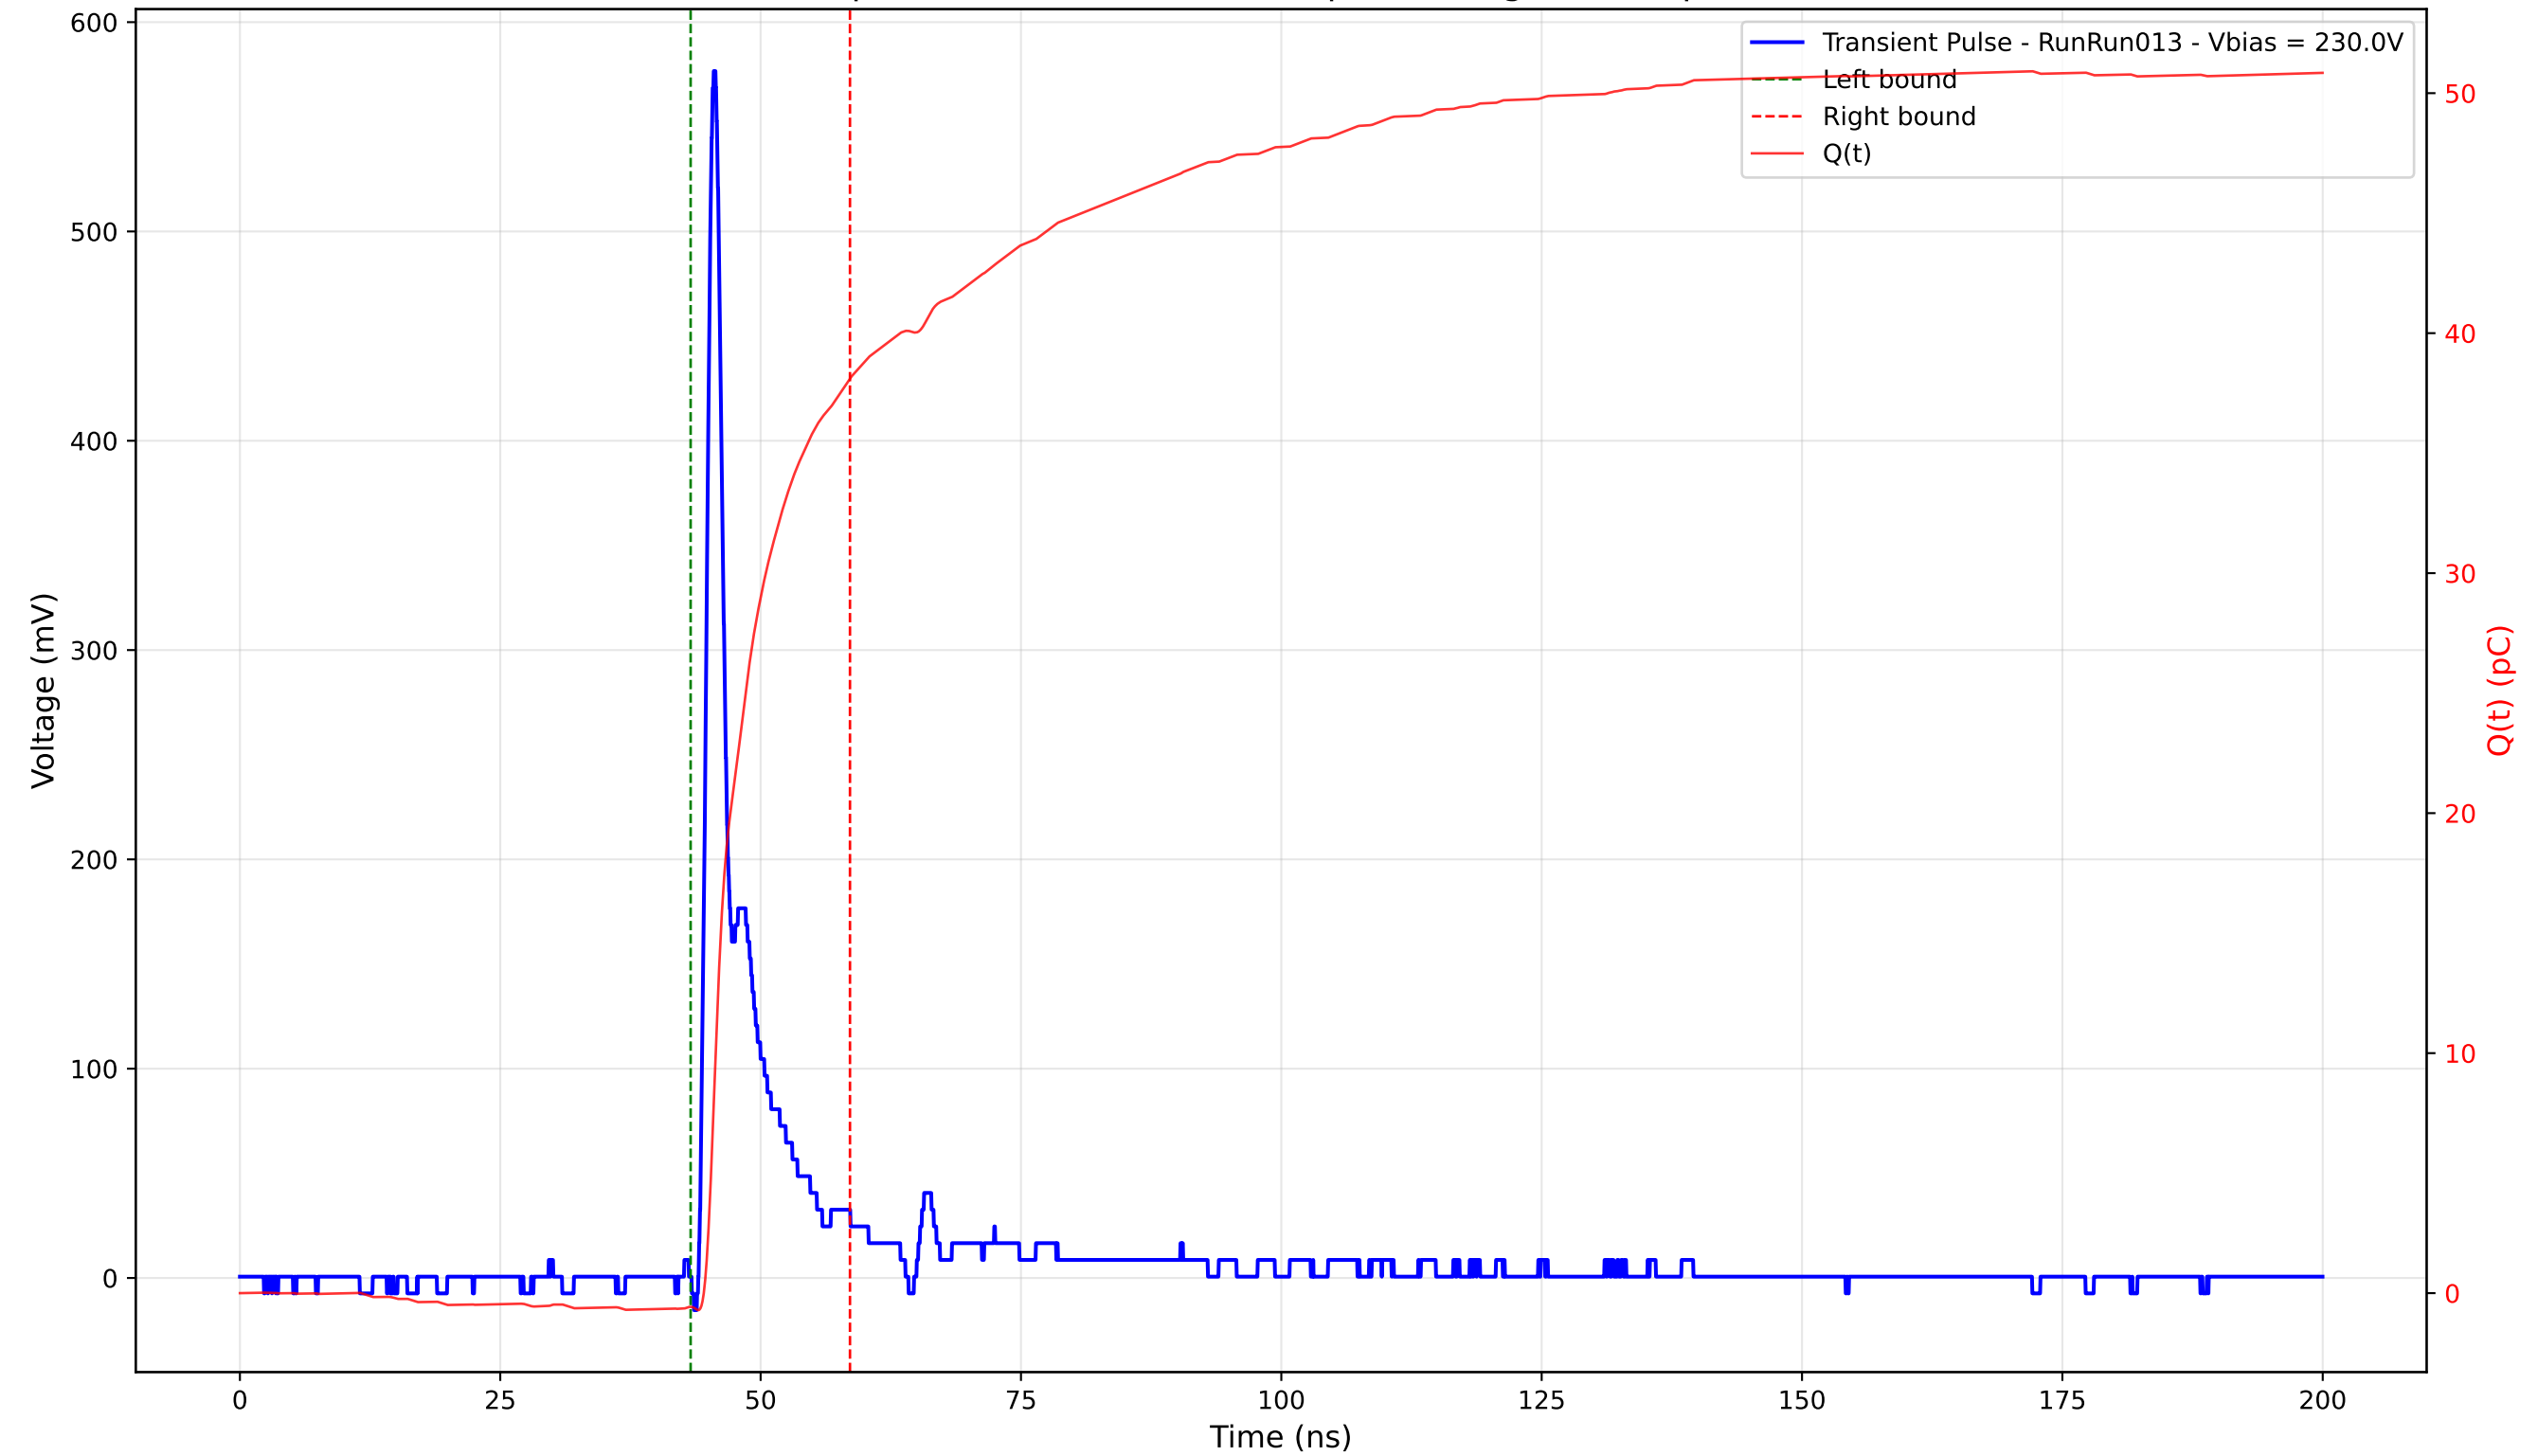


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 37.27 pC - Rise Time: 0.97 ns

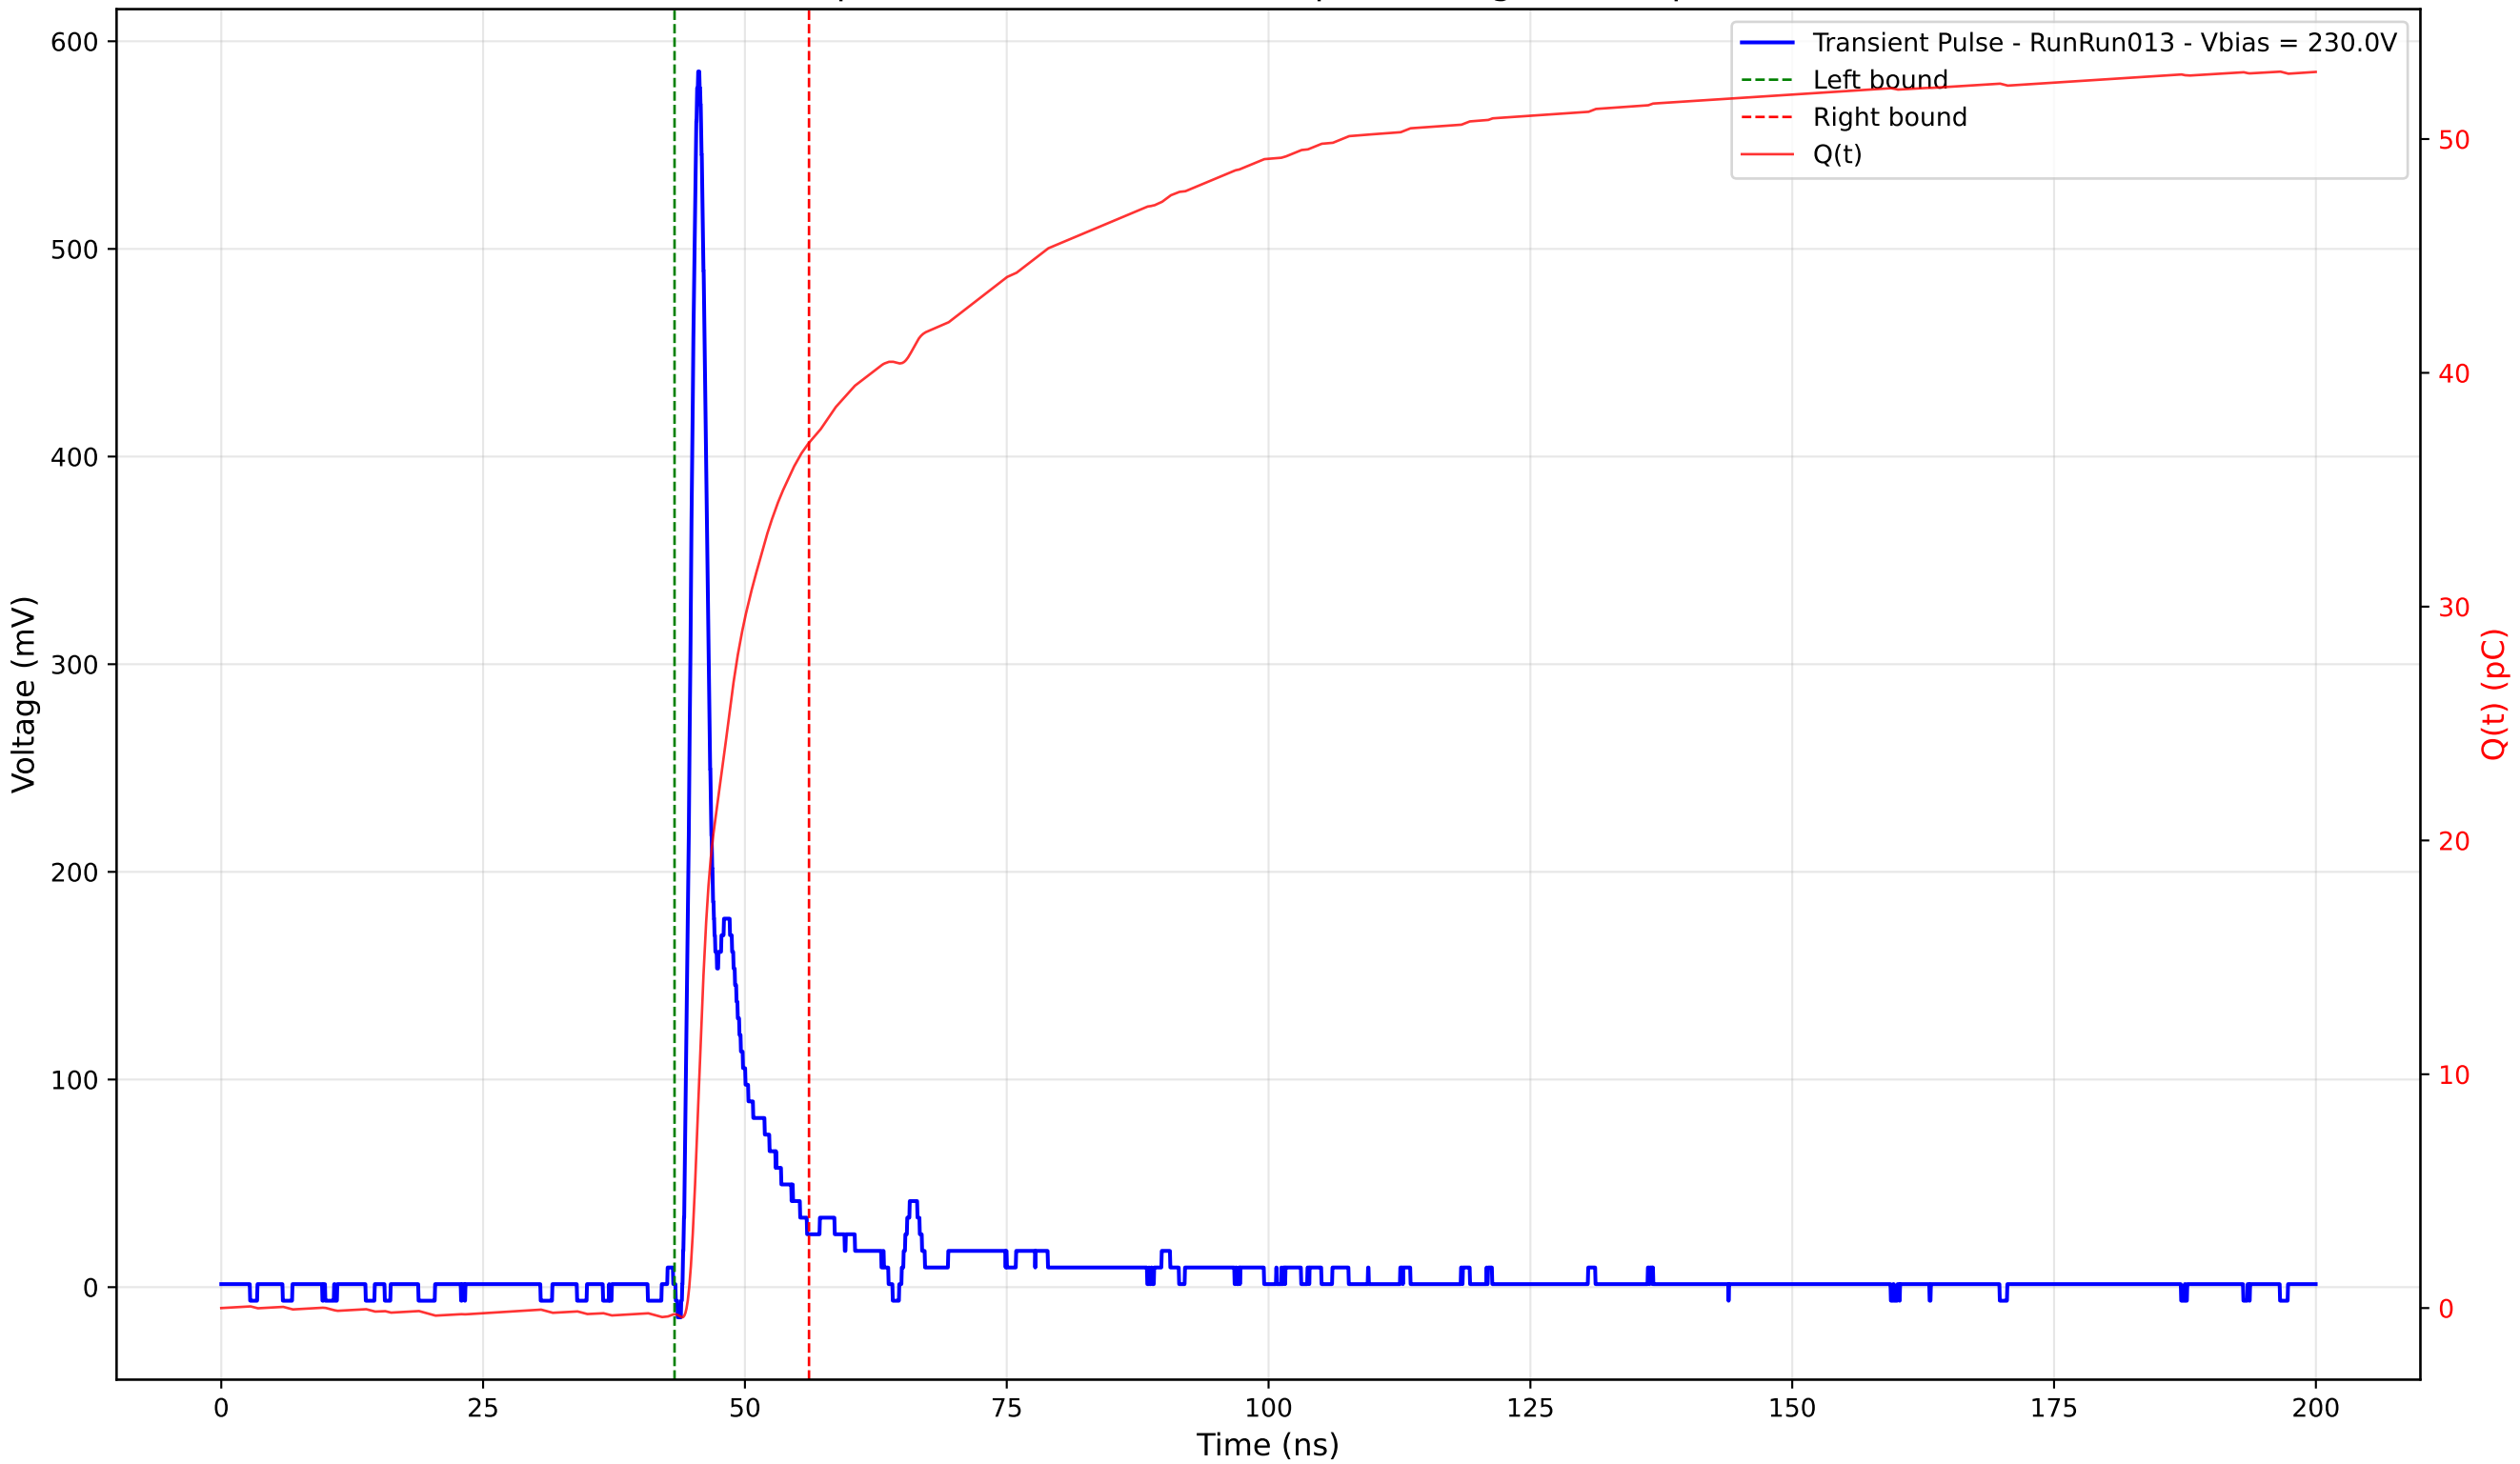


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 37.45 pC - Rise Time: 0.97 ns

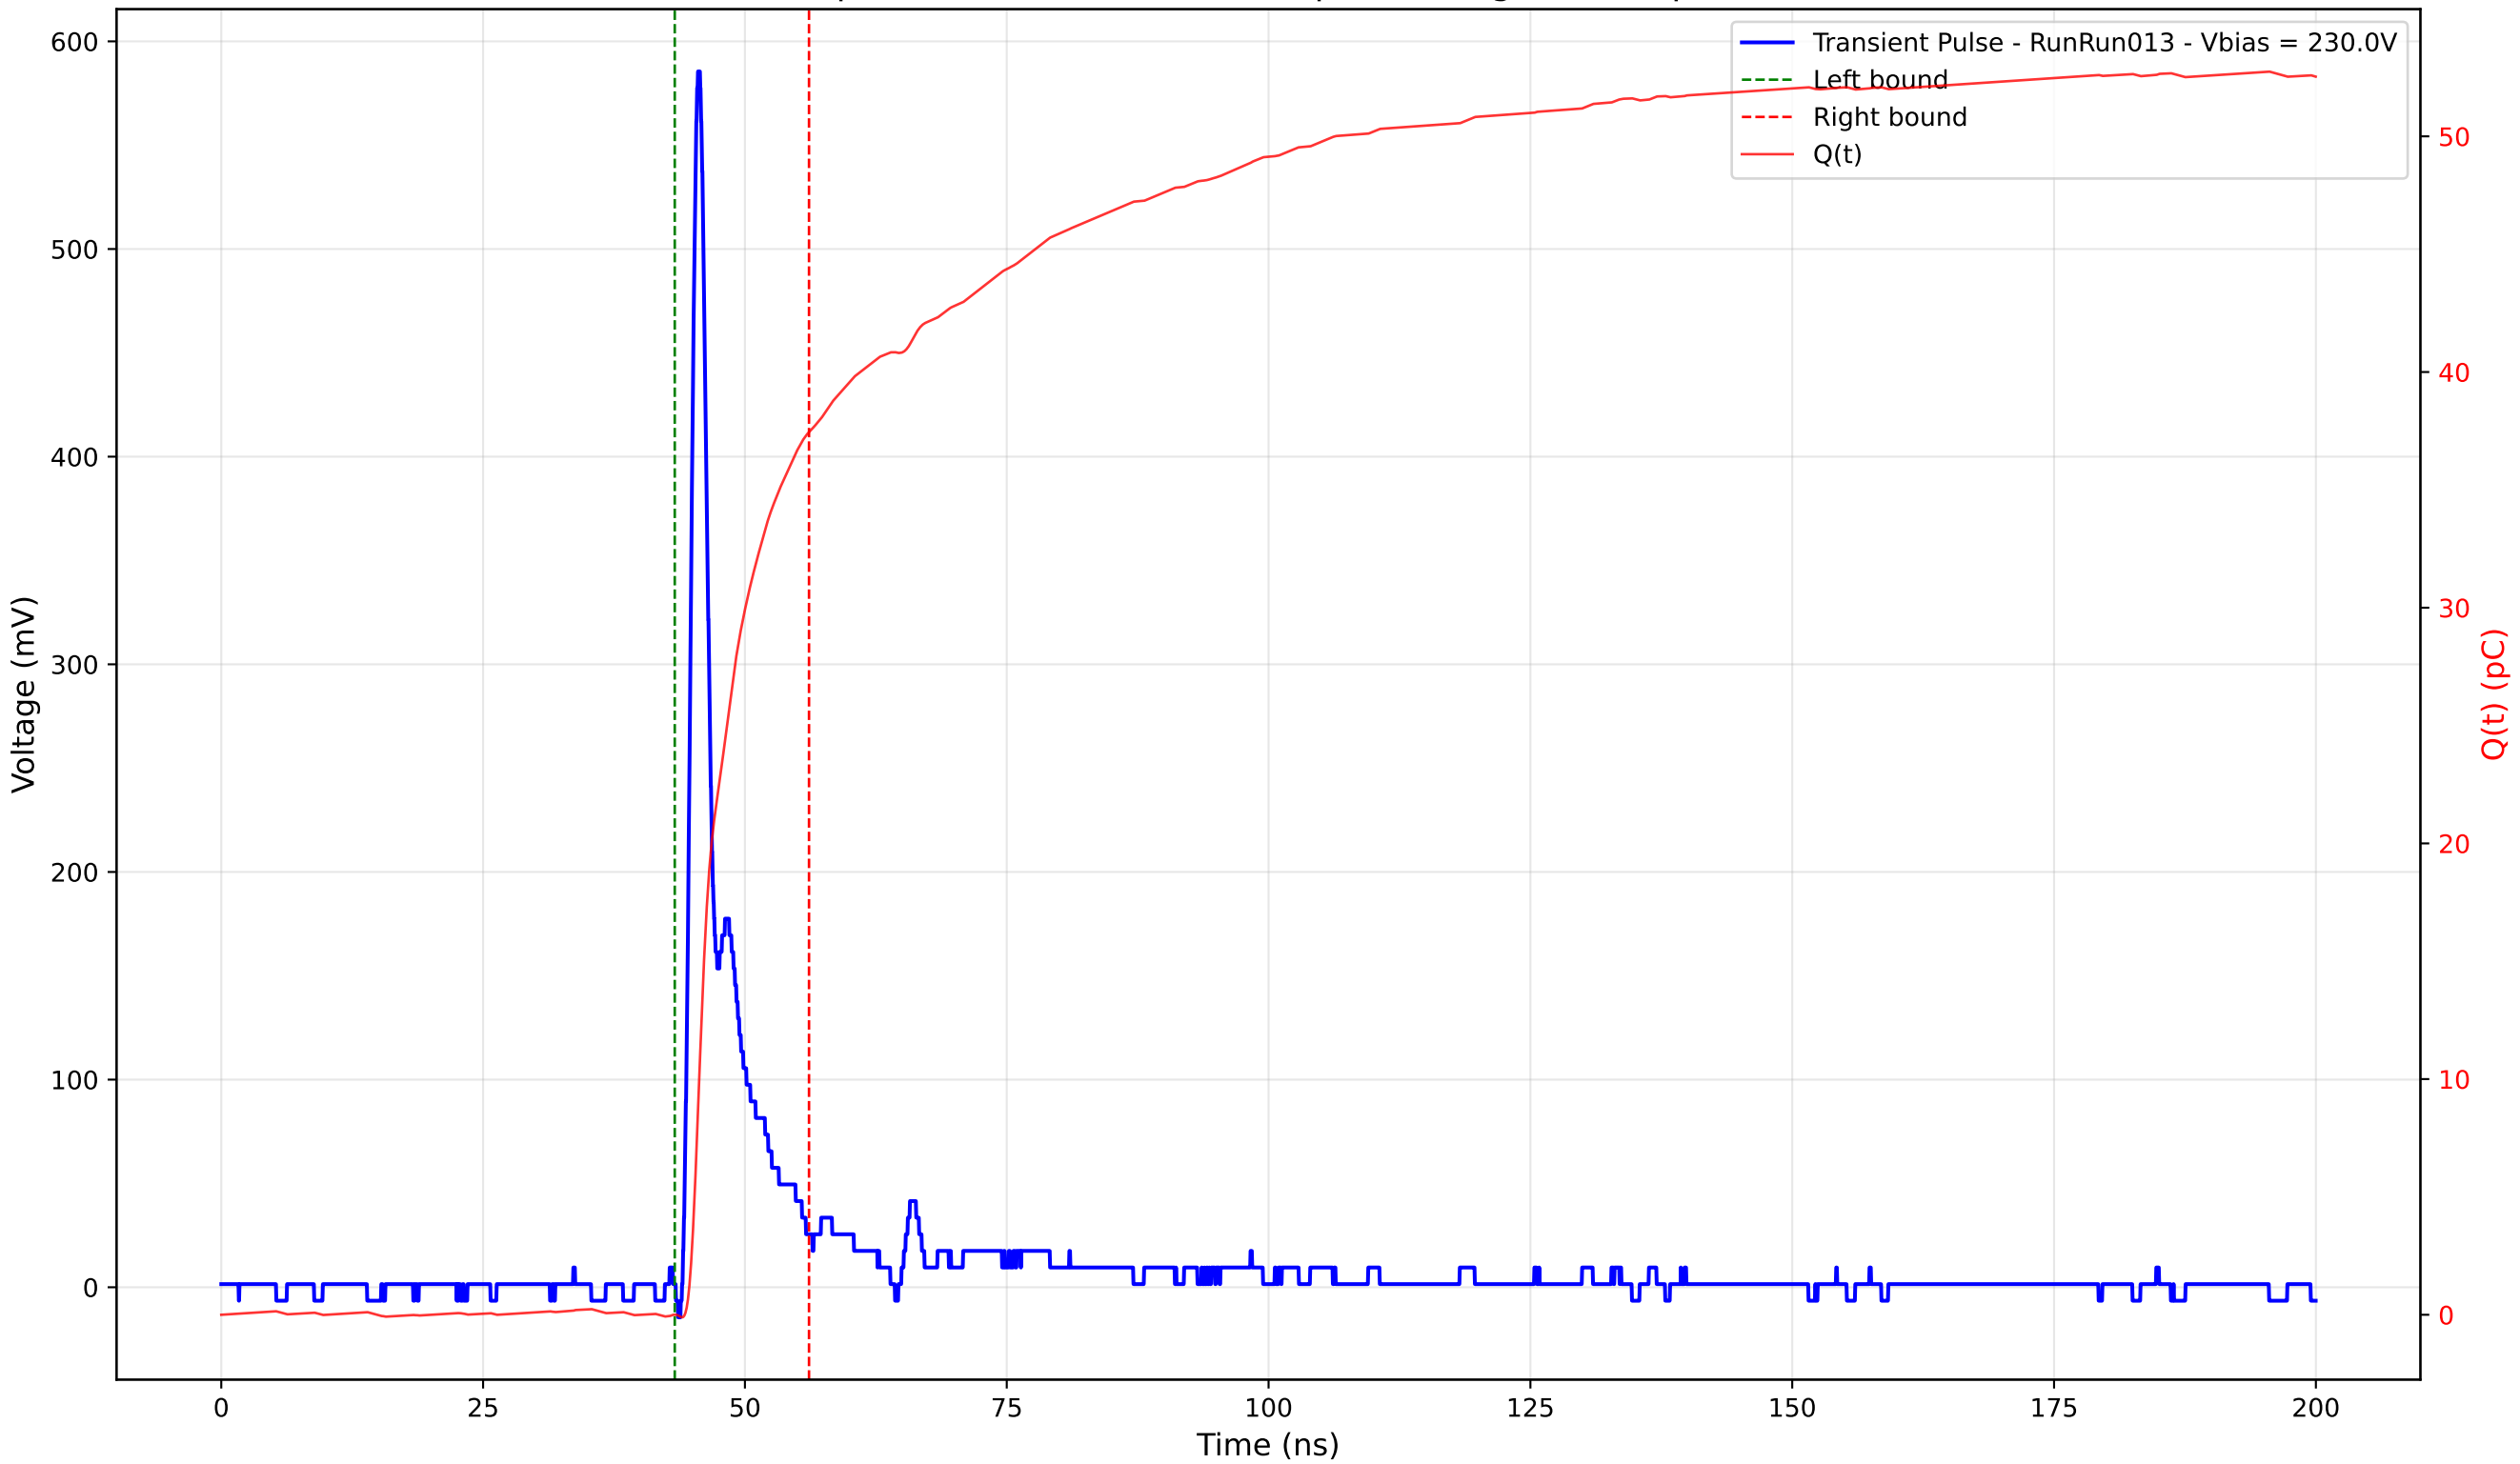


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 37.11 pC - Rise Time: 0.97 ns

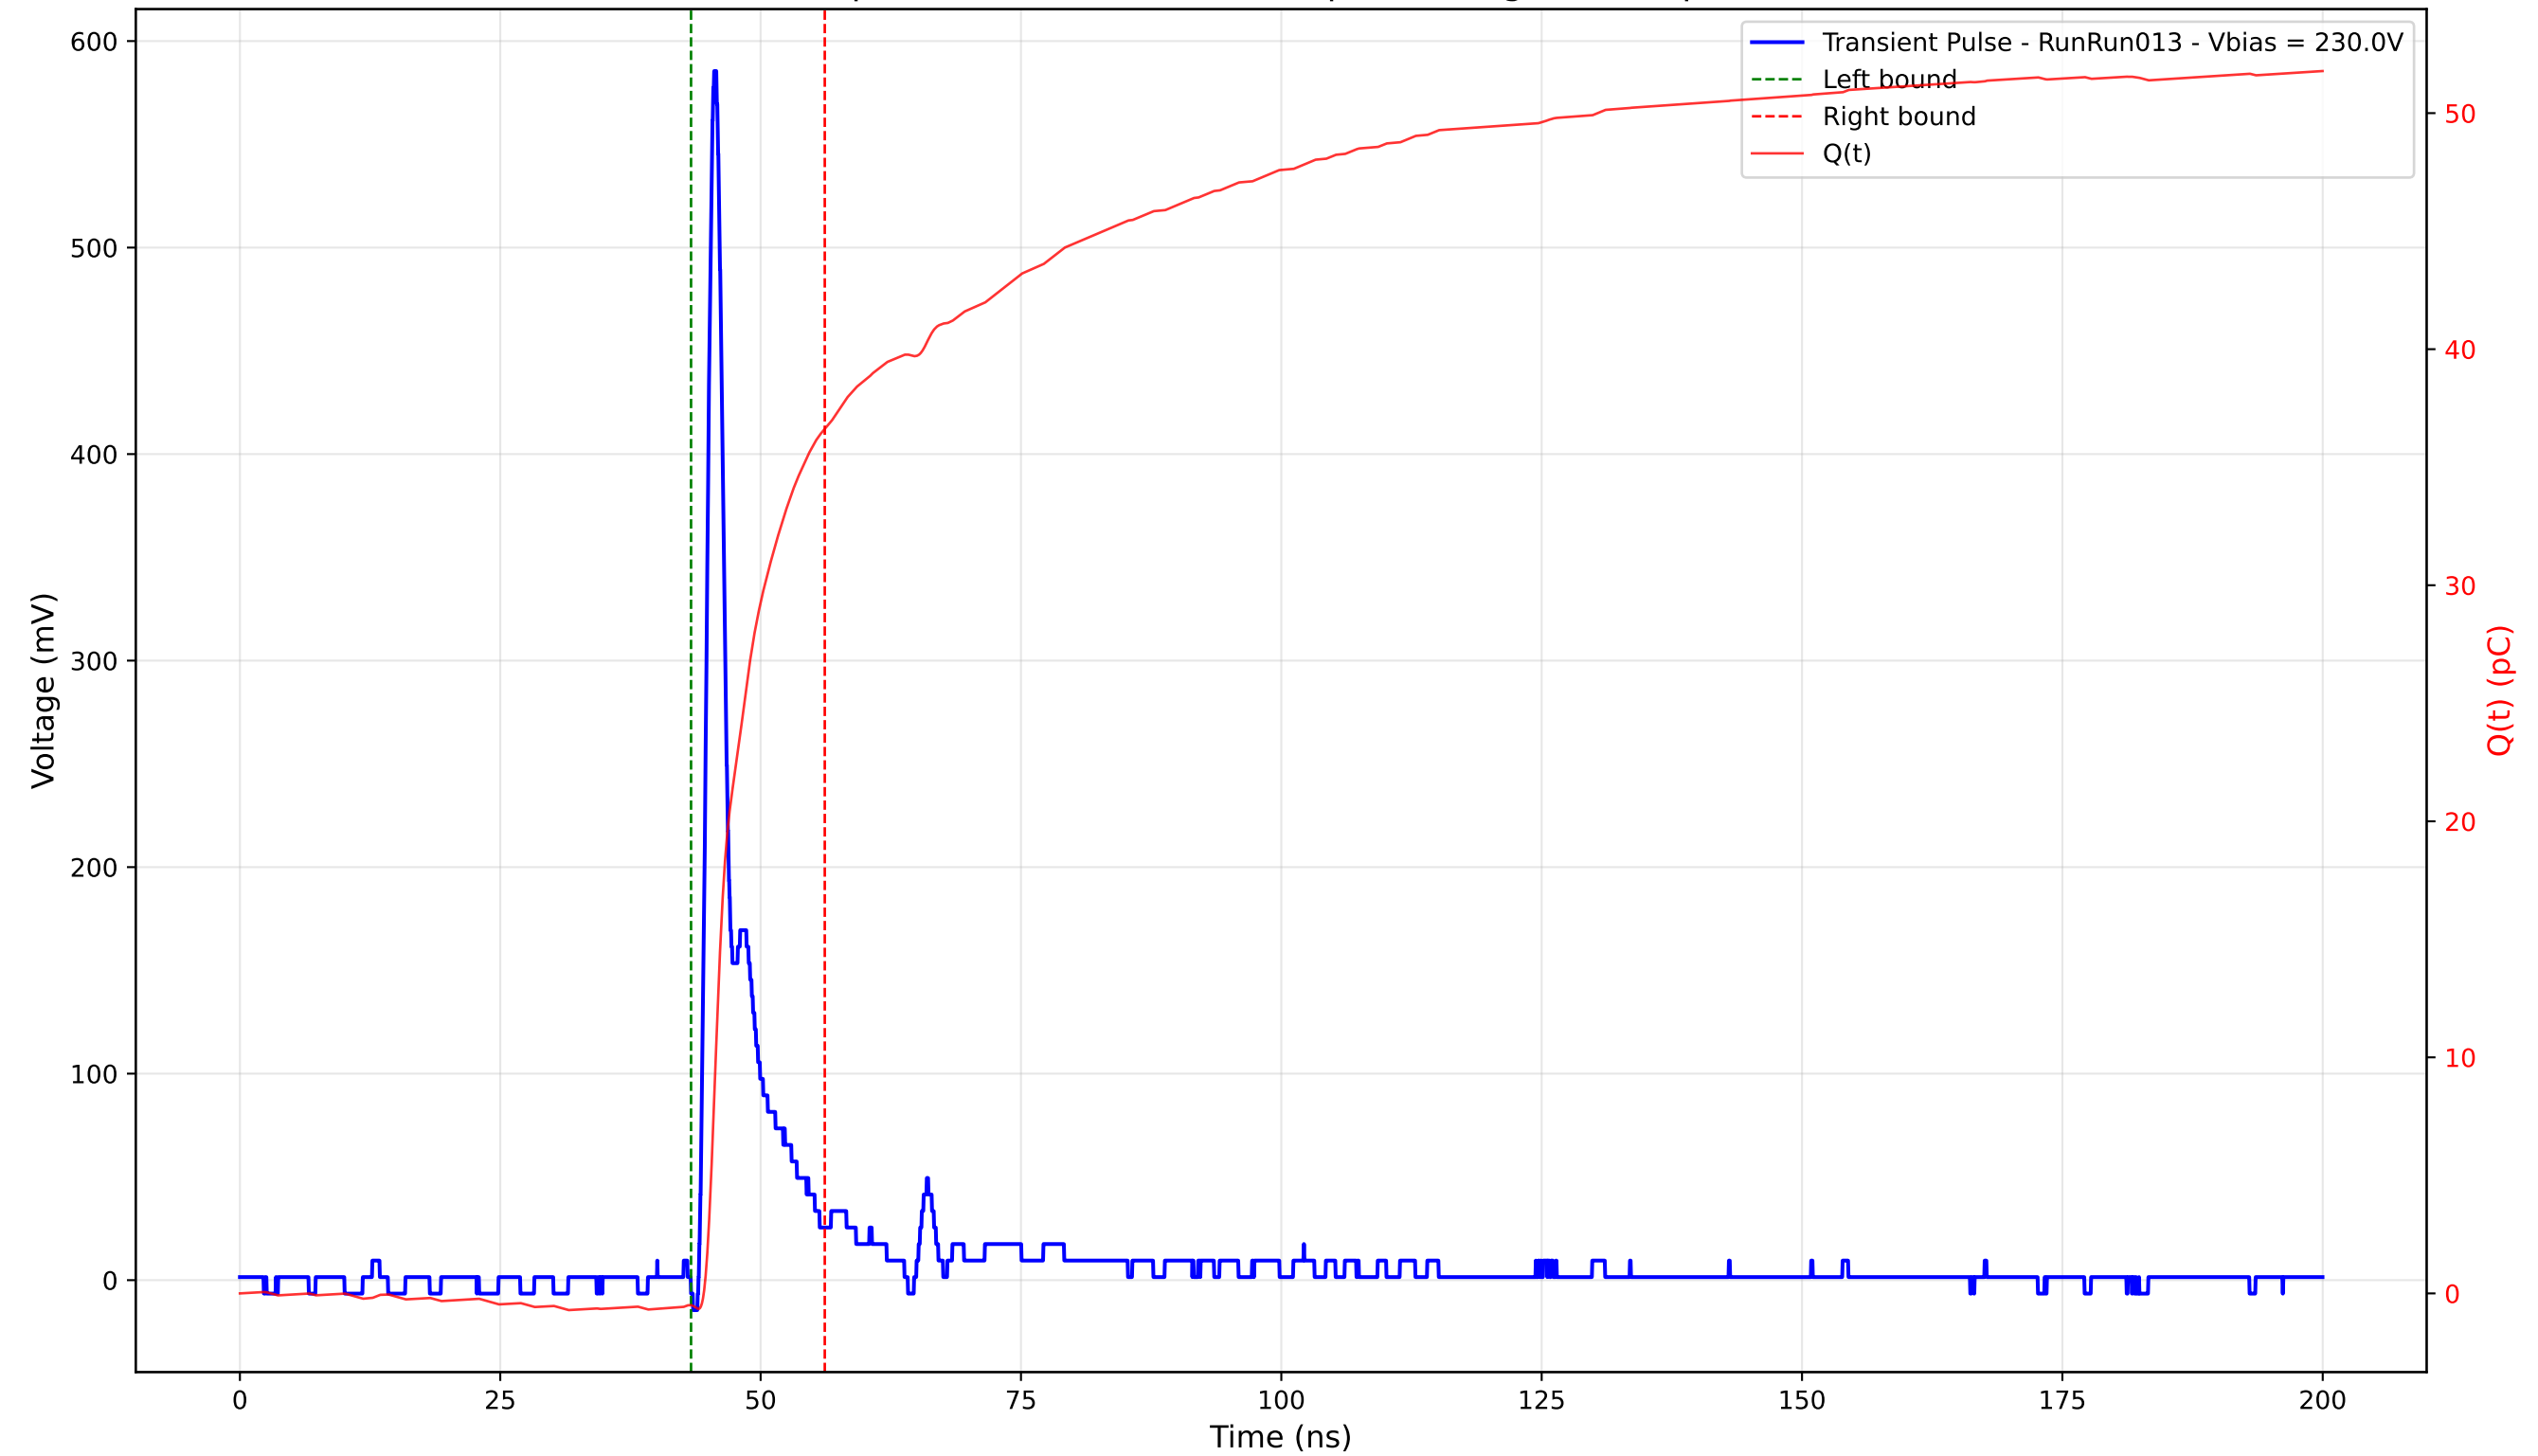


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 37.65 pC - Rise Time: 0.99 ns

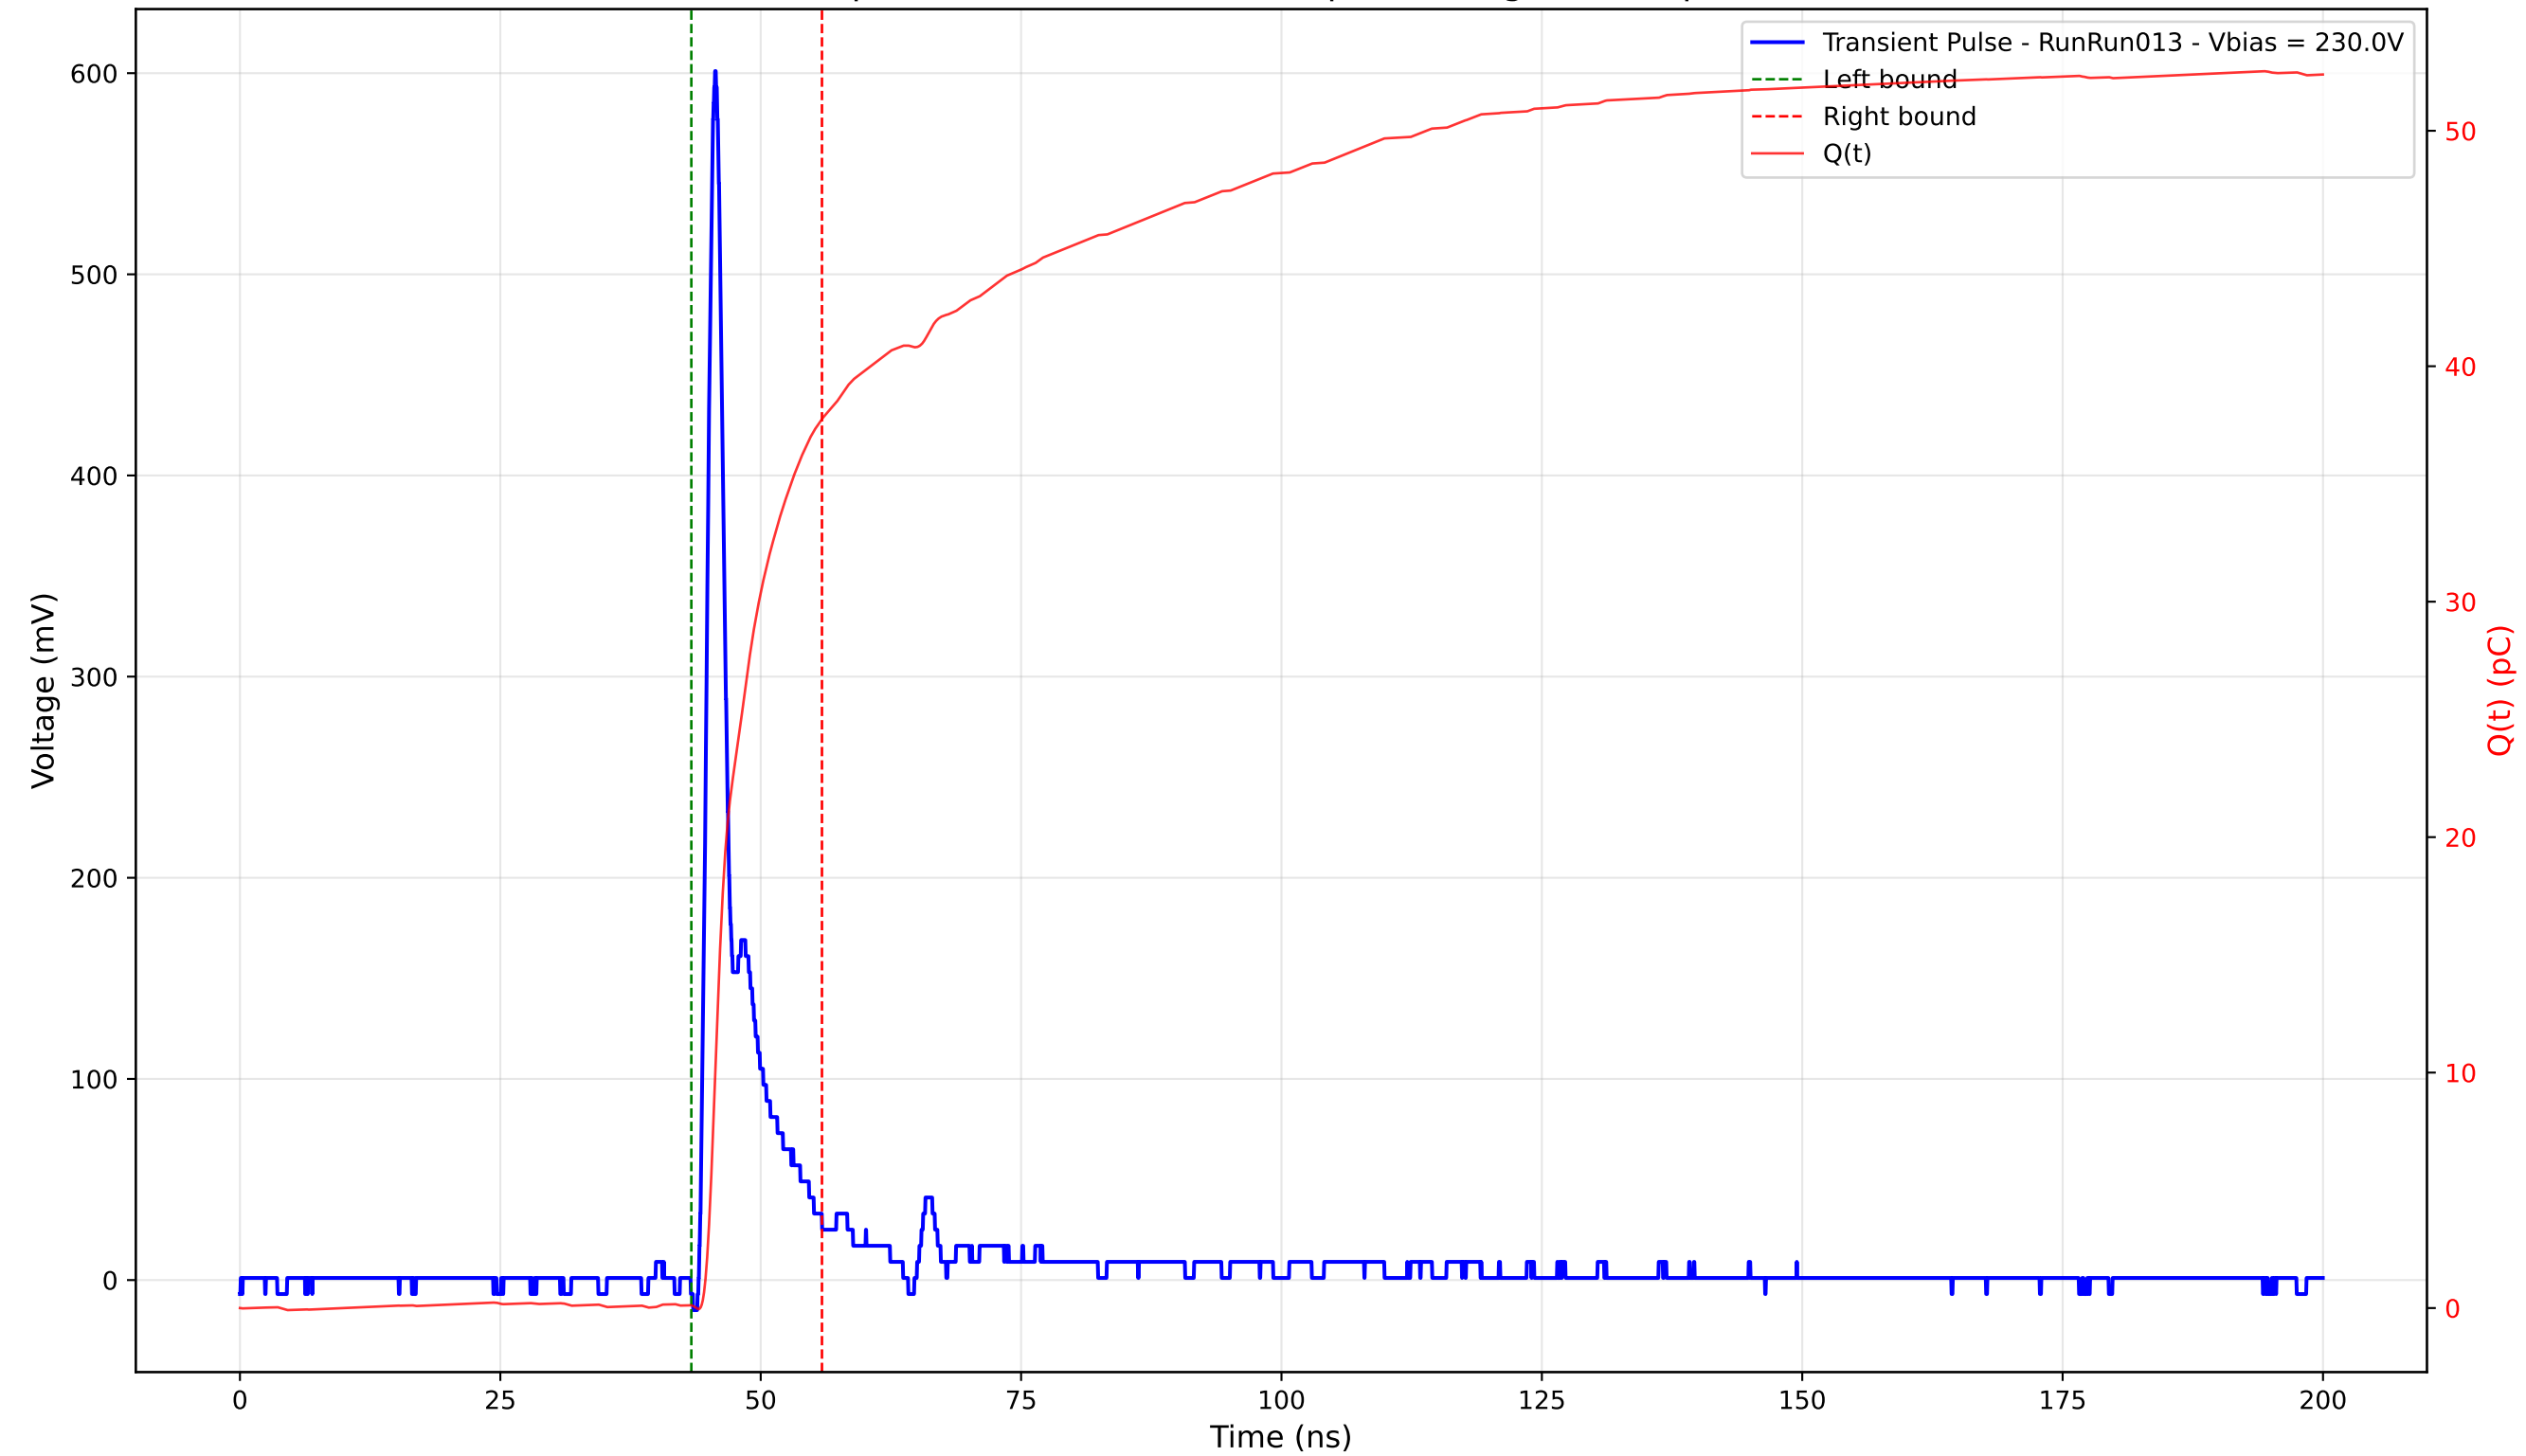


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 37.54 pC - Rise Time: 1.00 ns

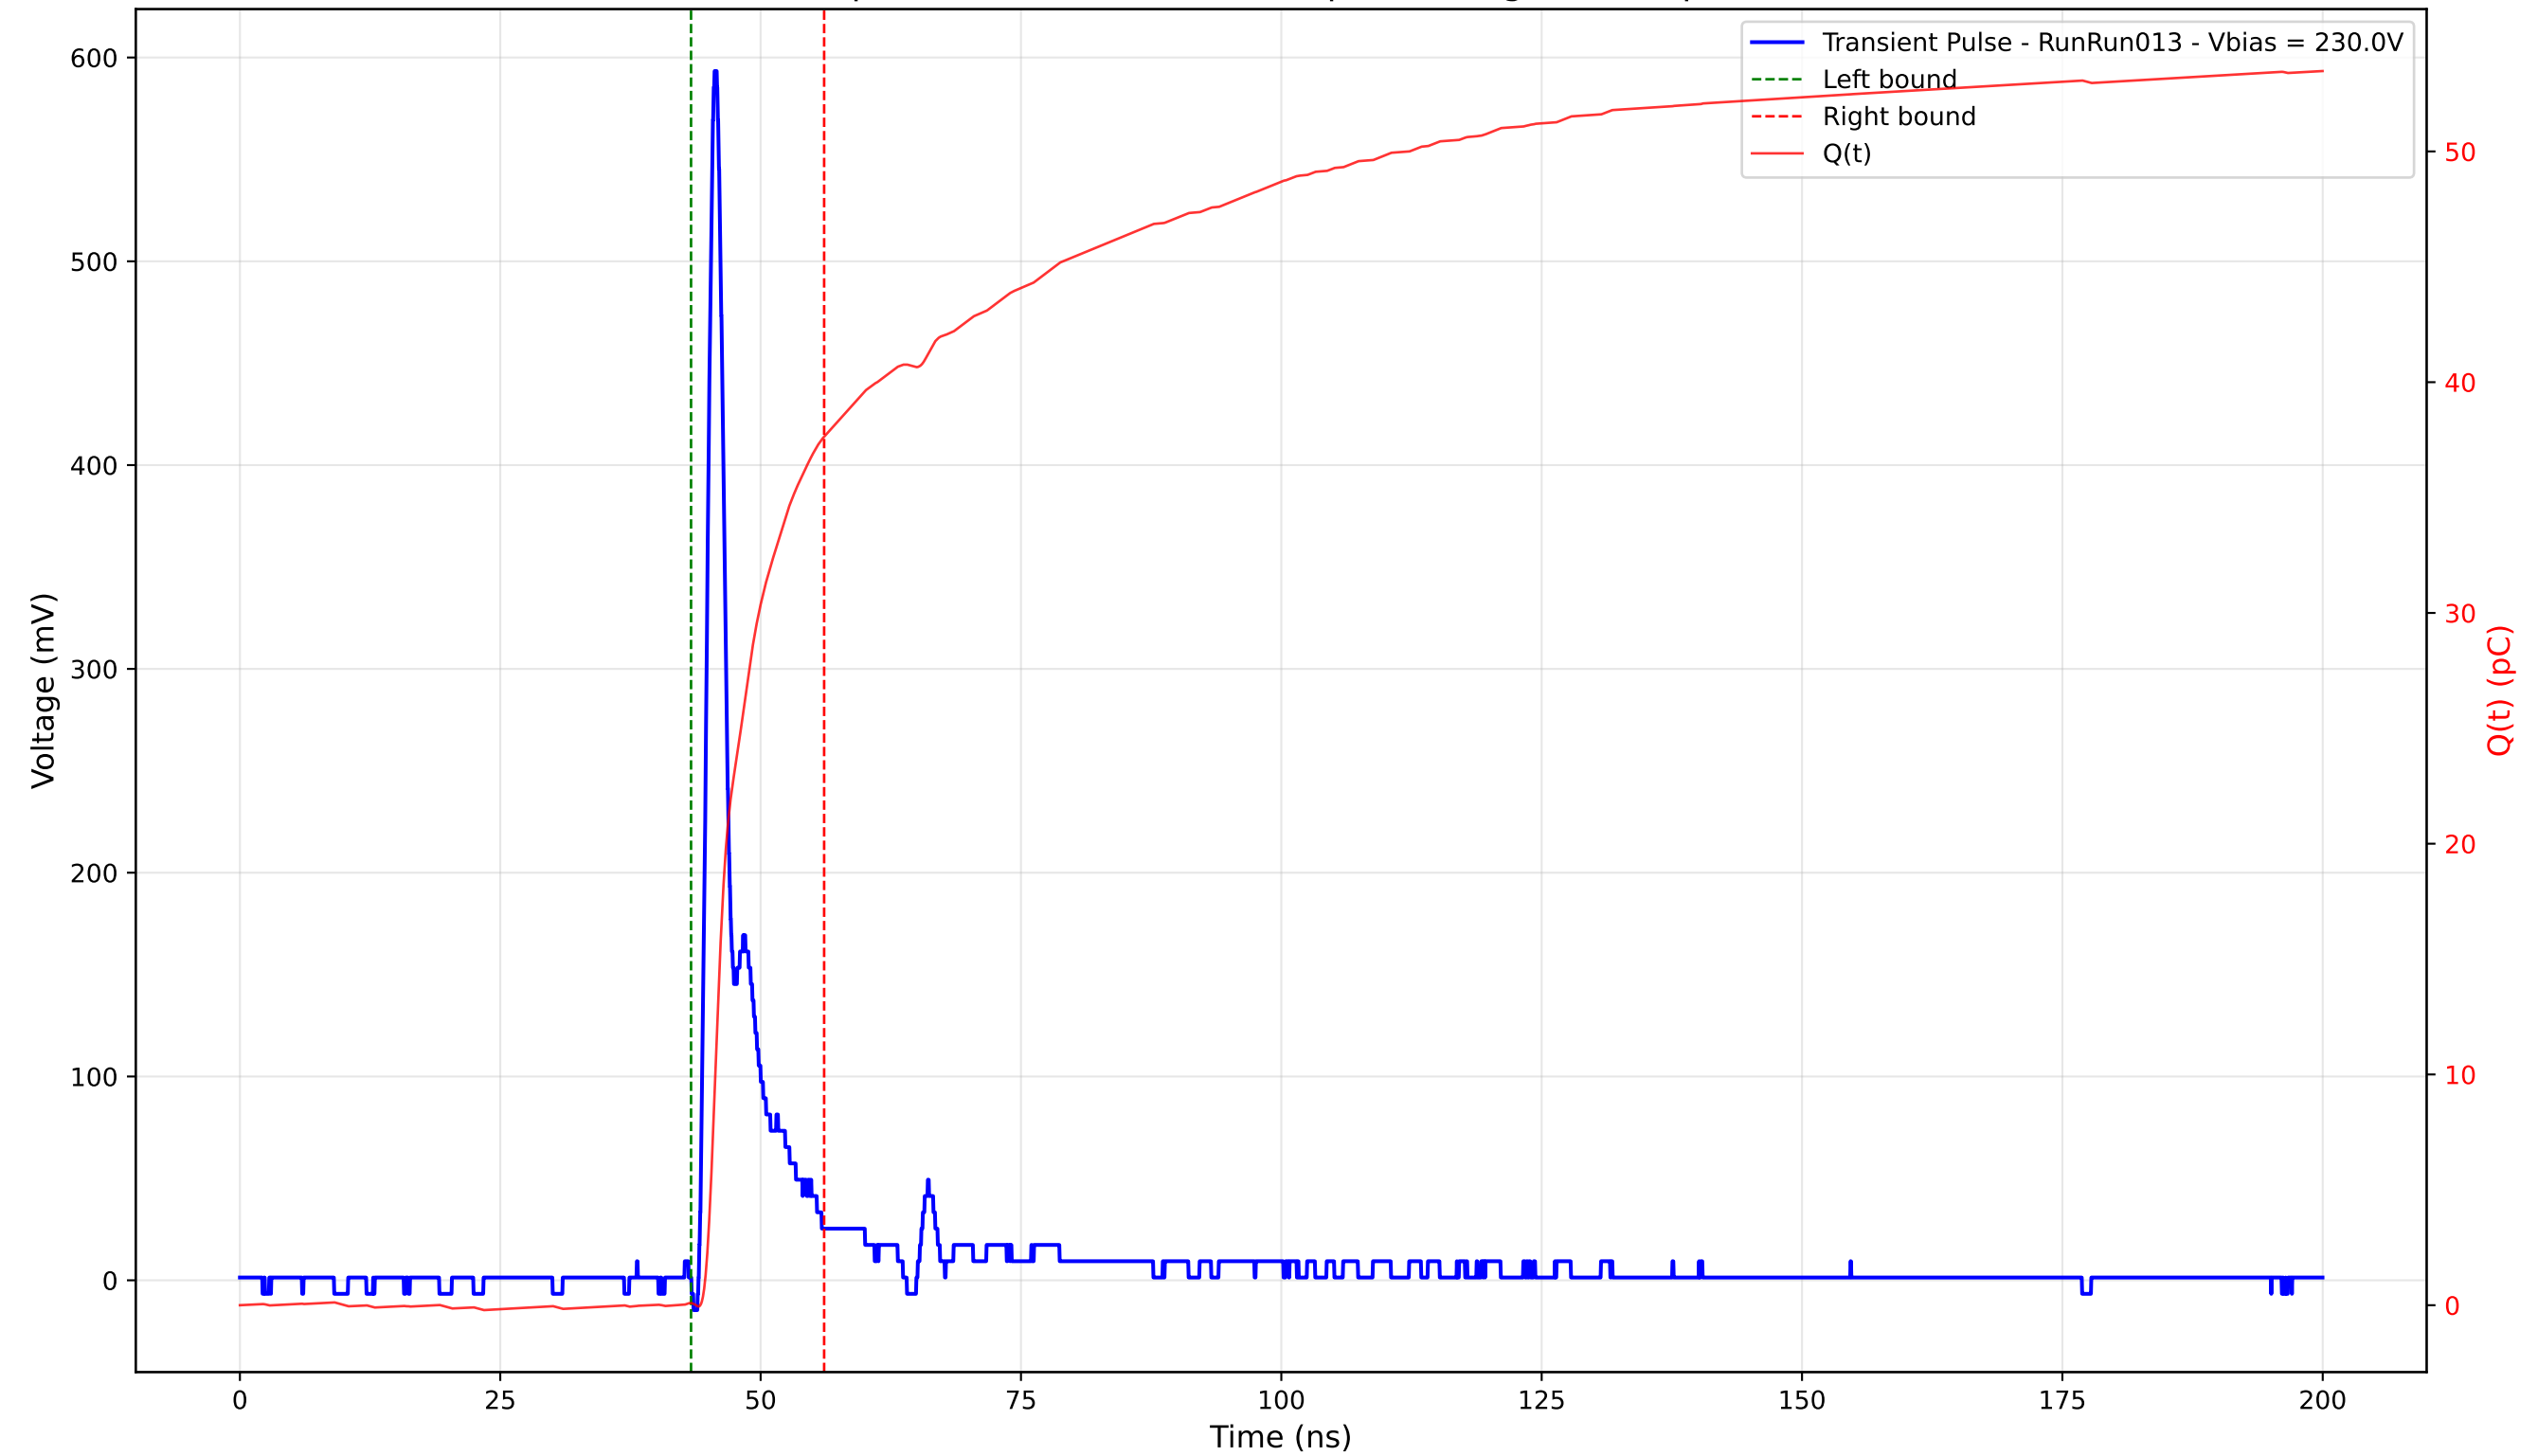


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 37.14 pC - Rise Time: 1.01 ns

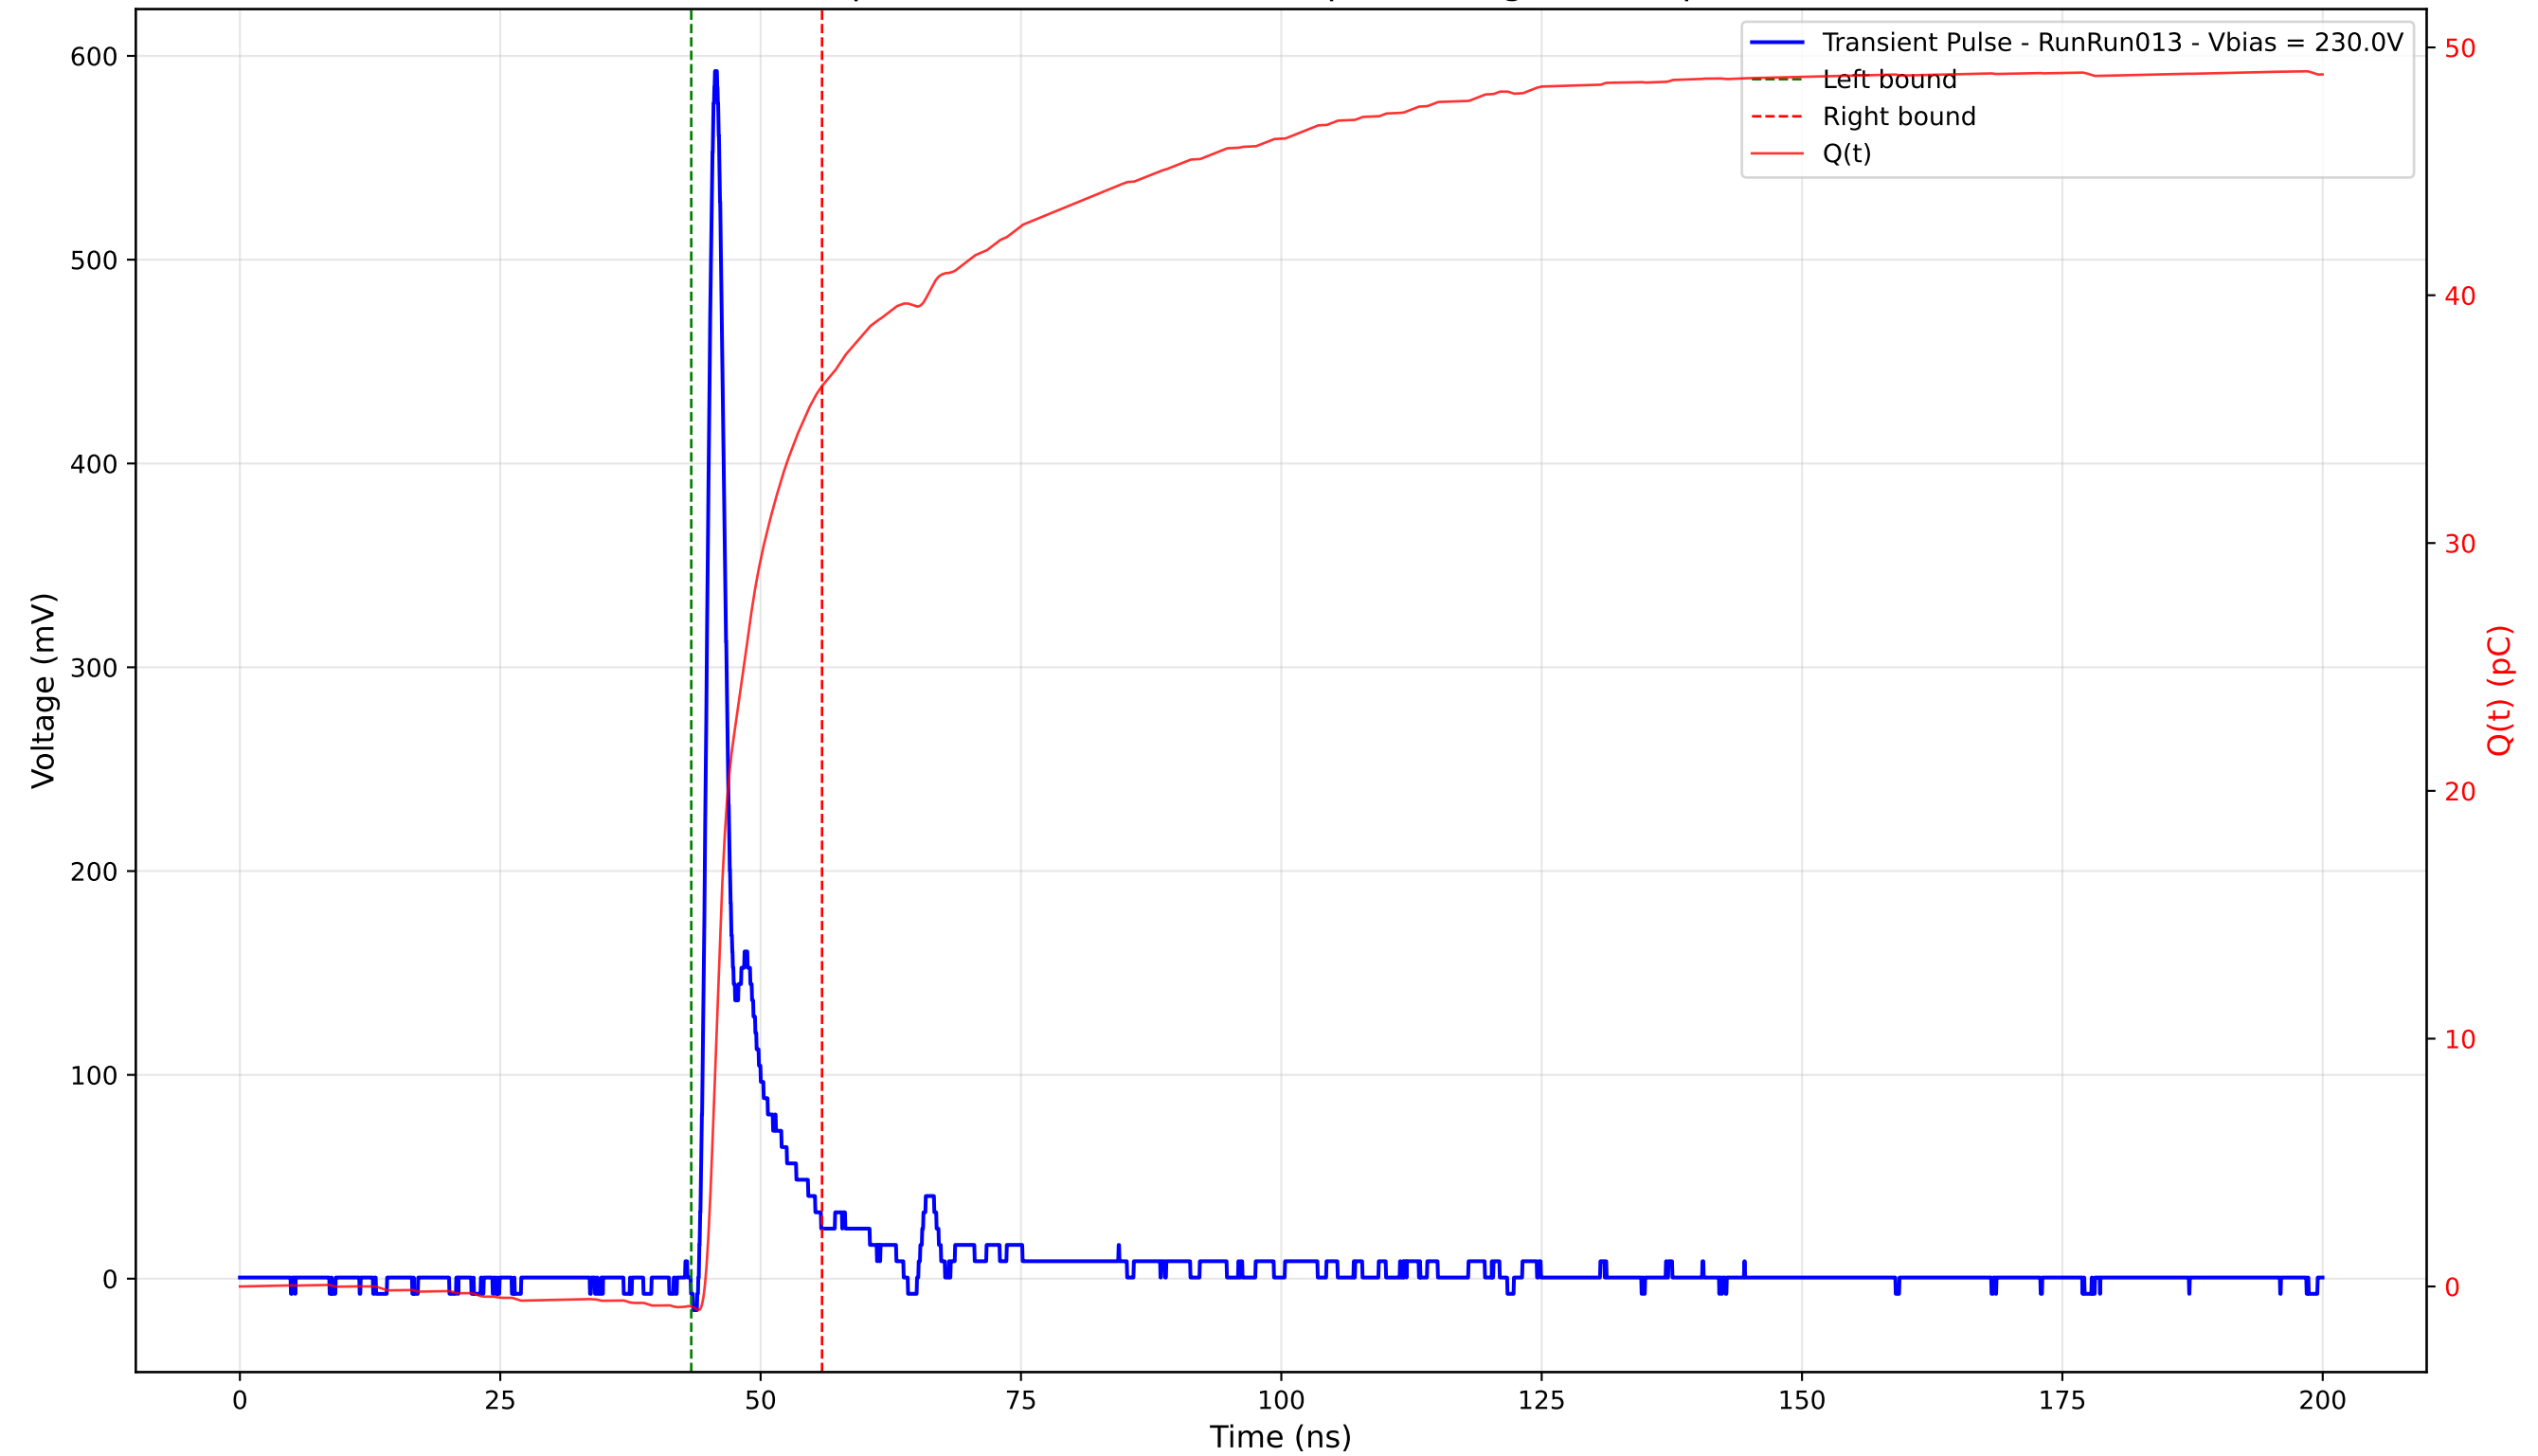


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 37.13 pC - Rise Time: 1.05 ns

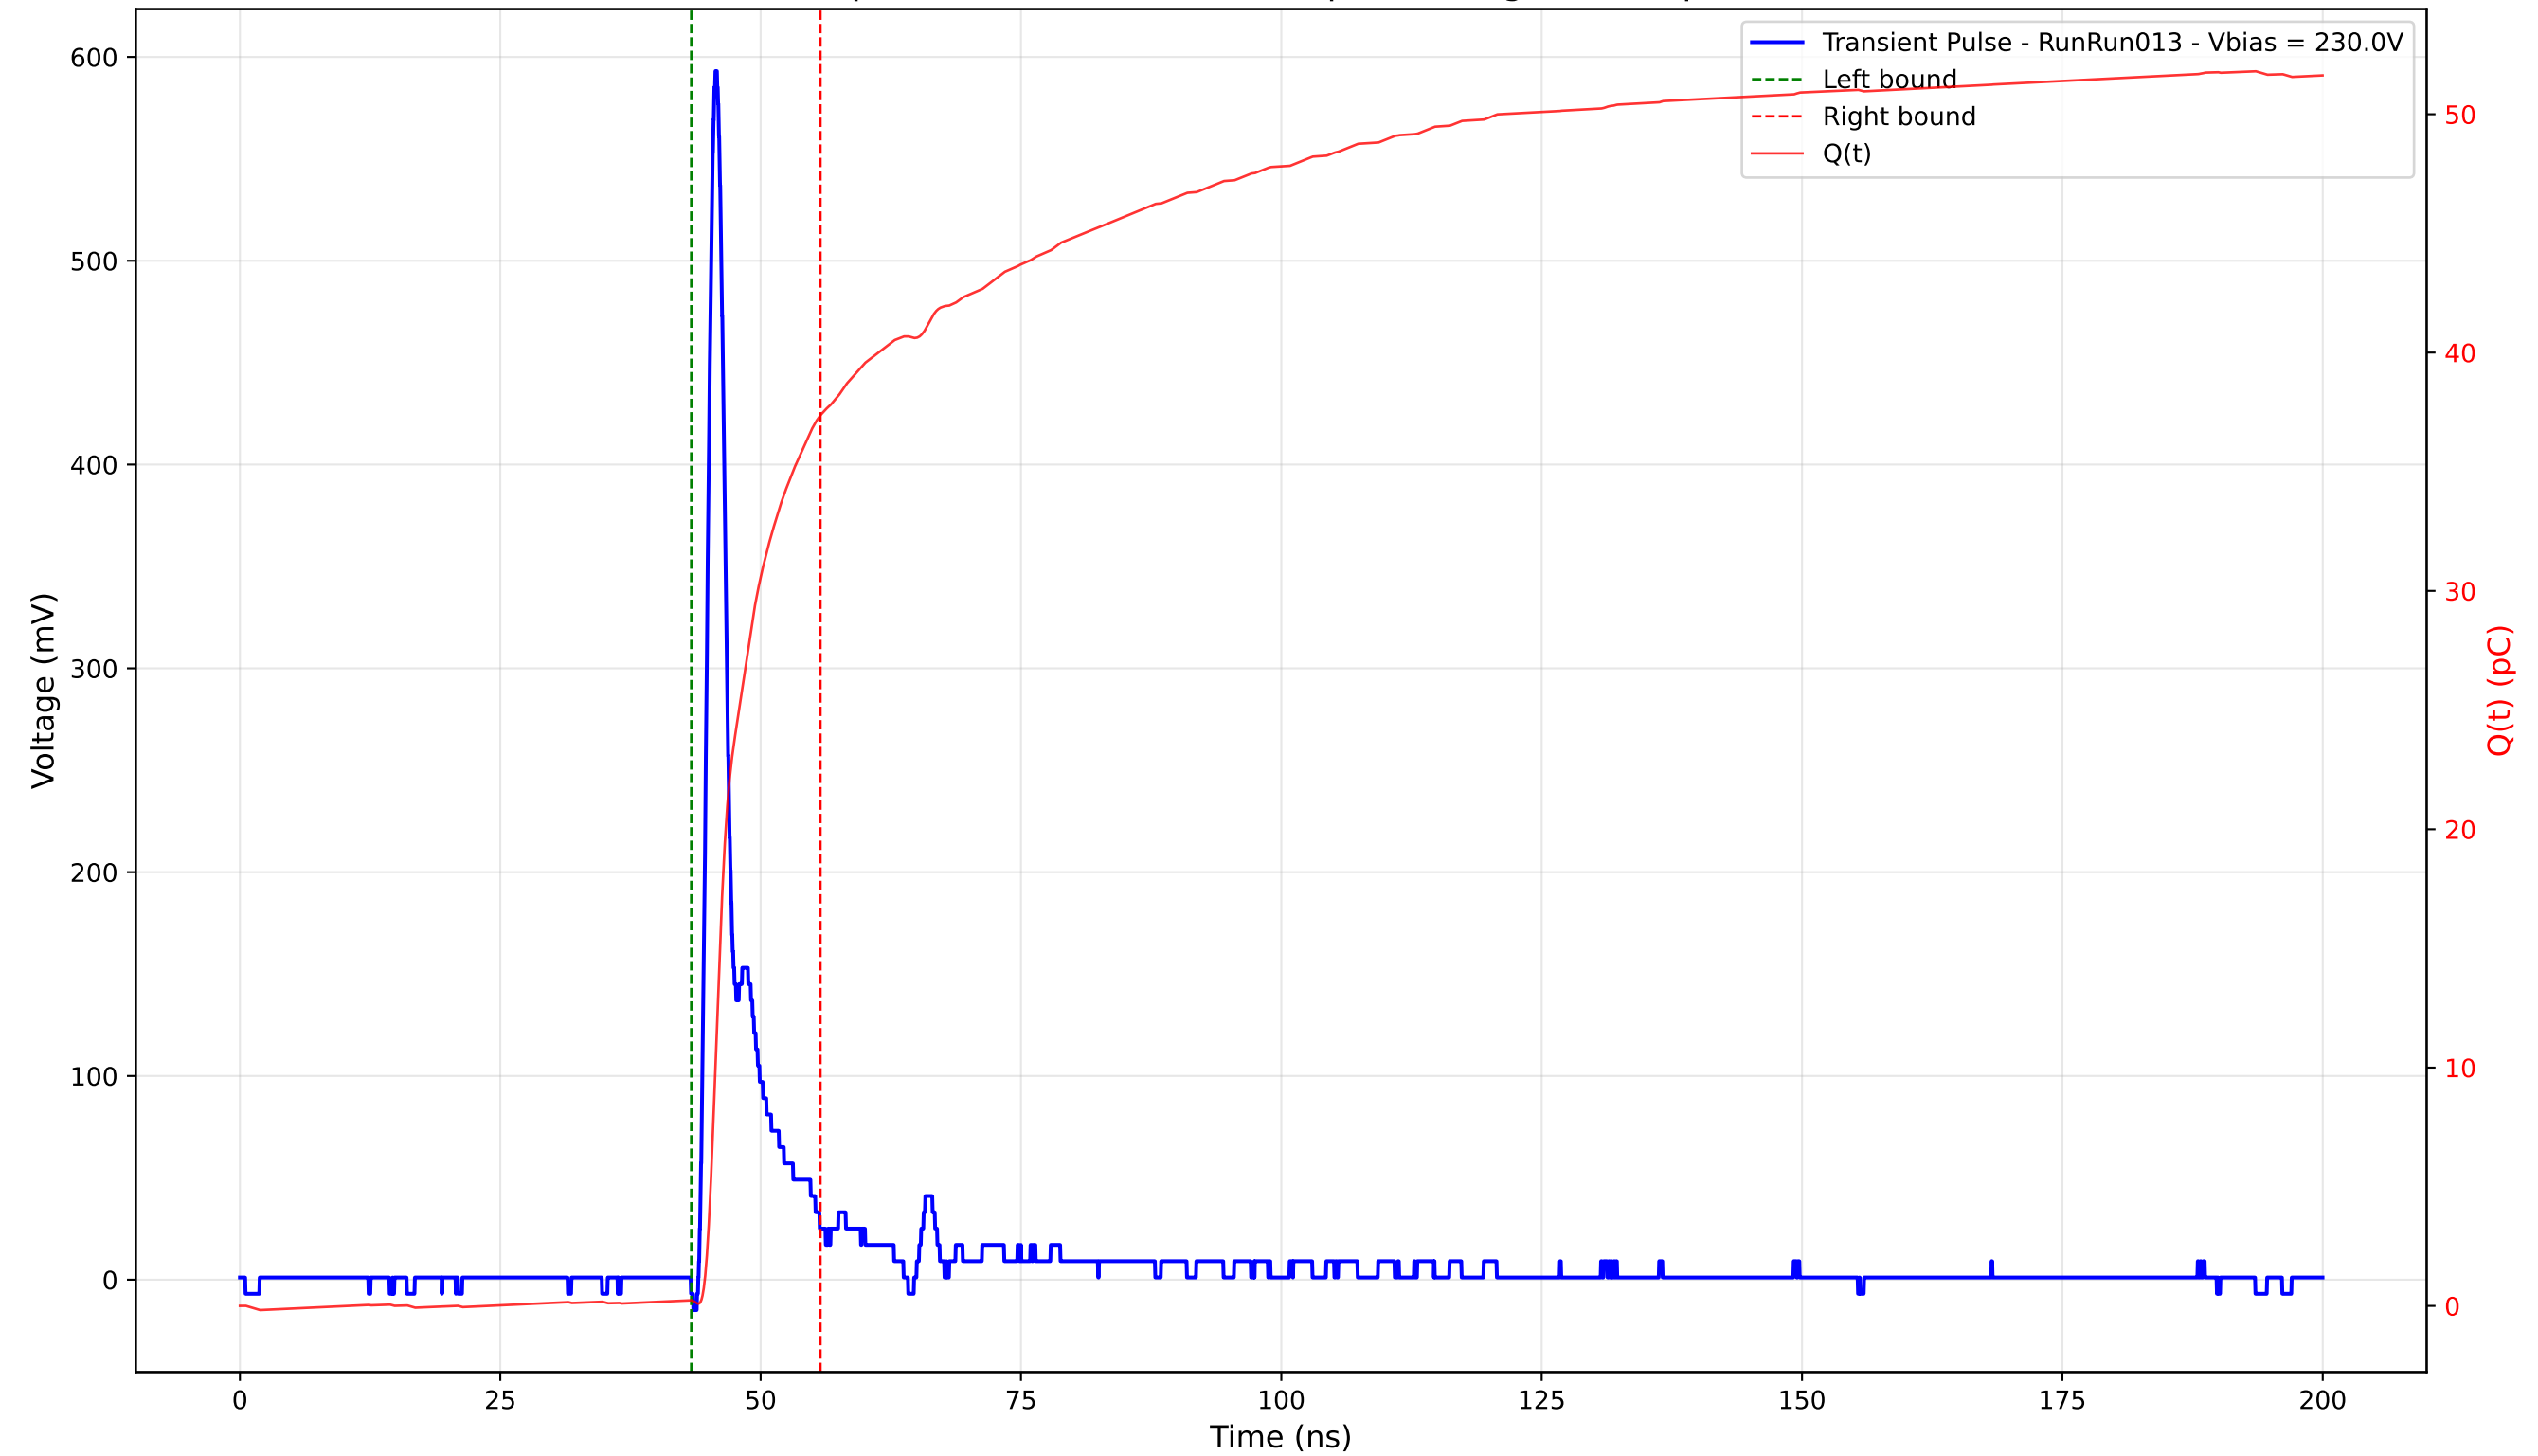


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 37.27 pC - Rise Time: 1.05 ns

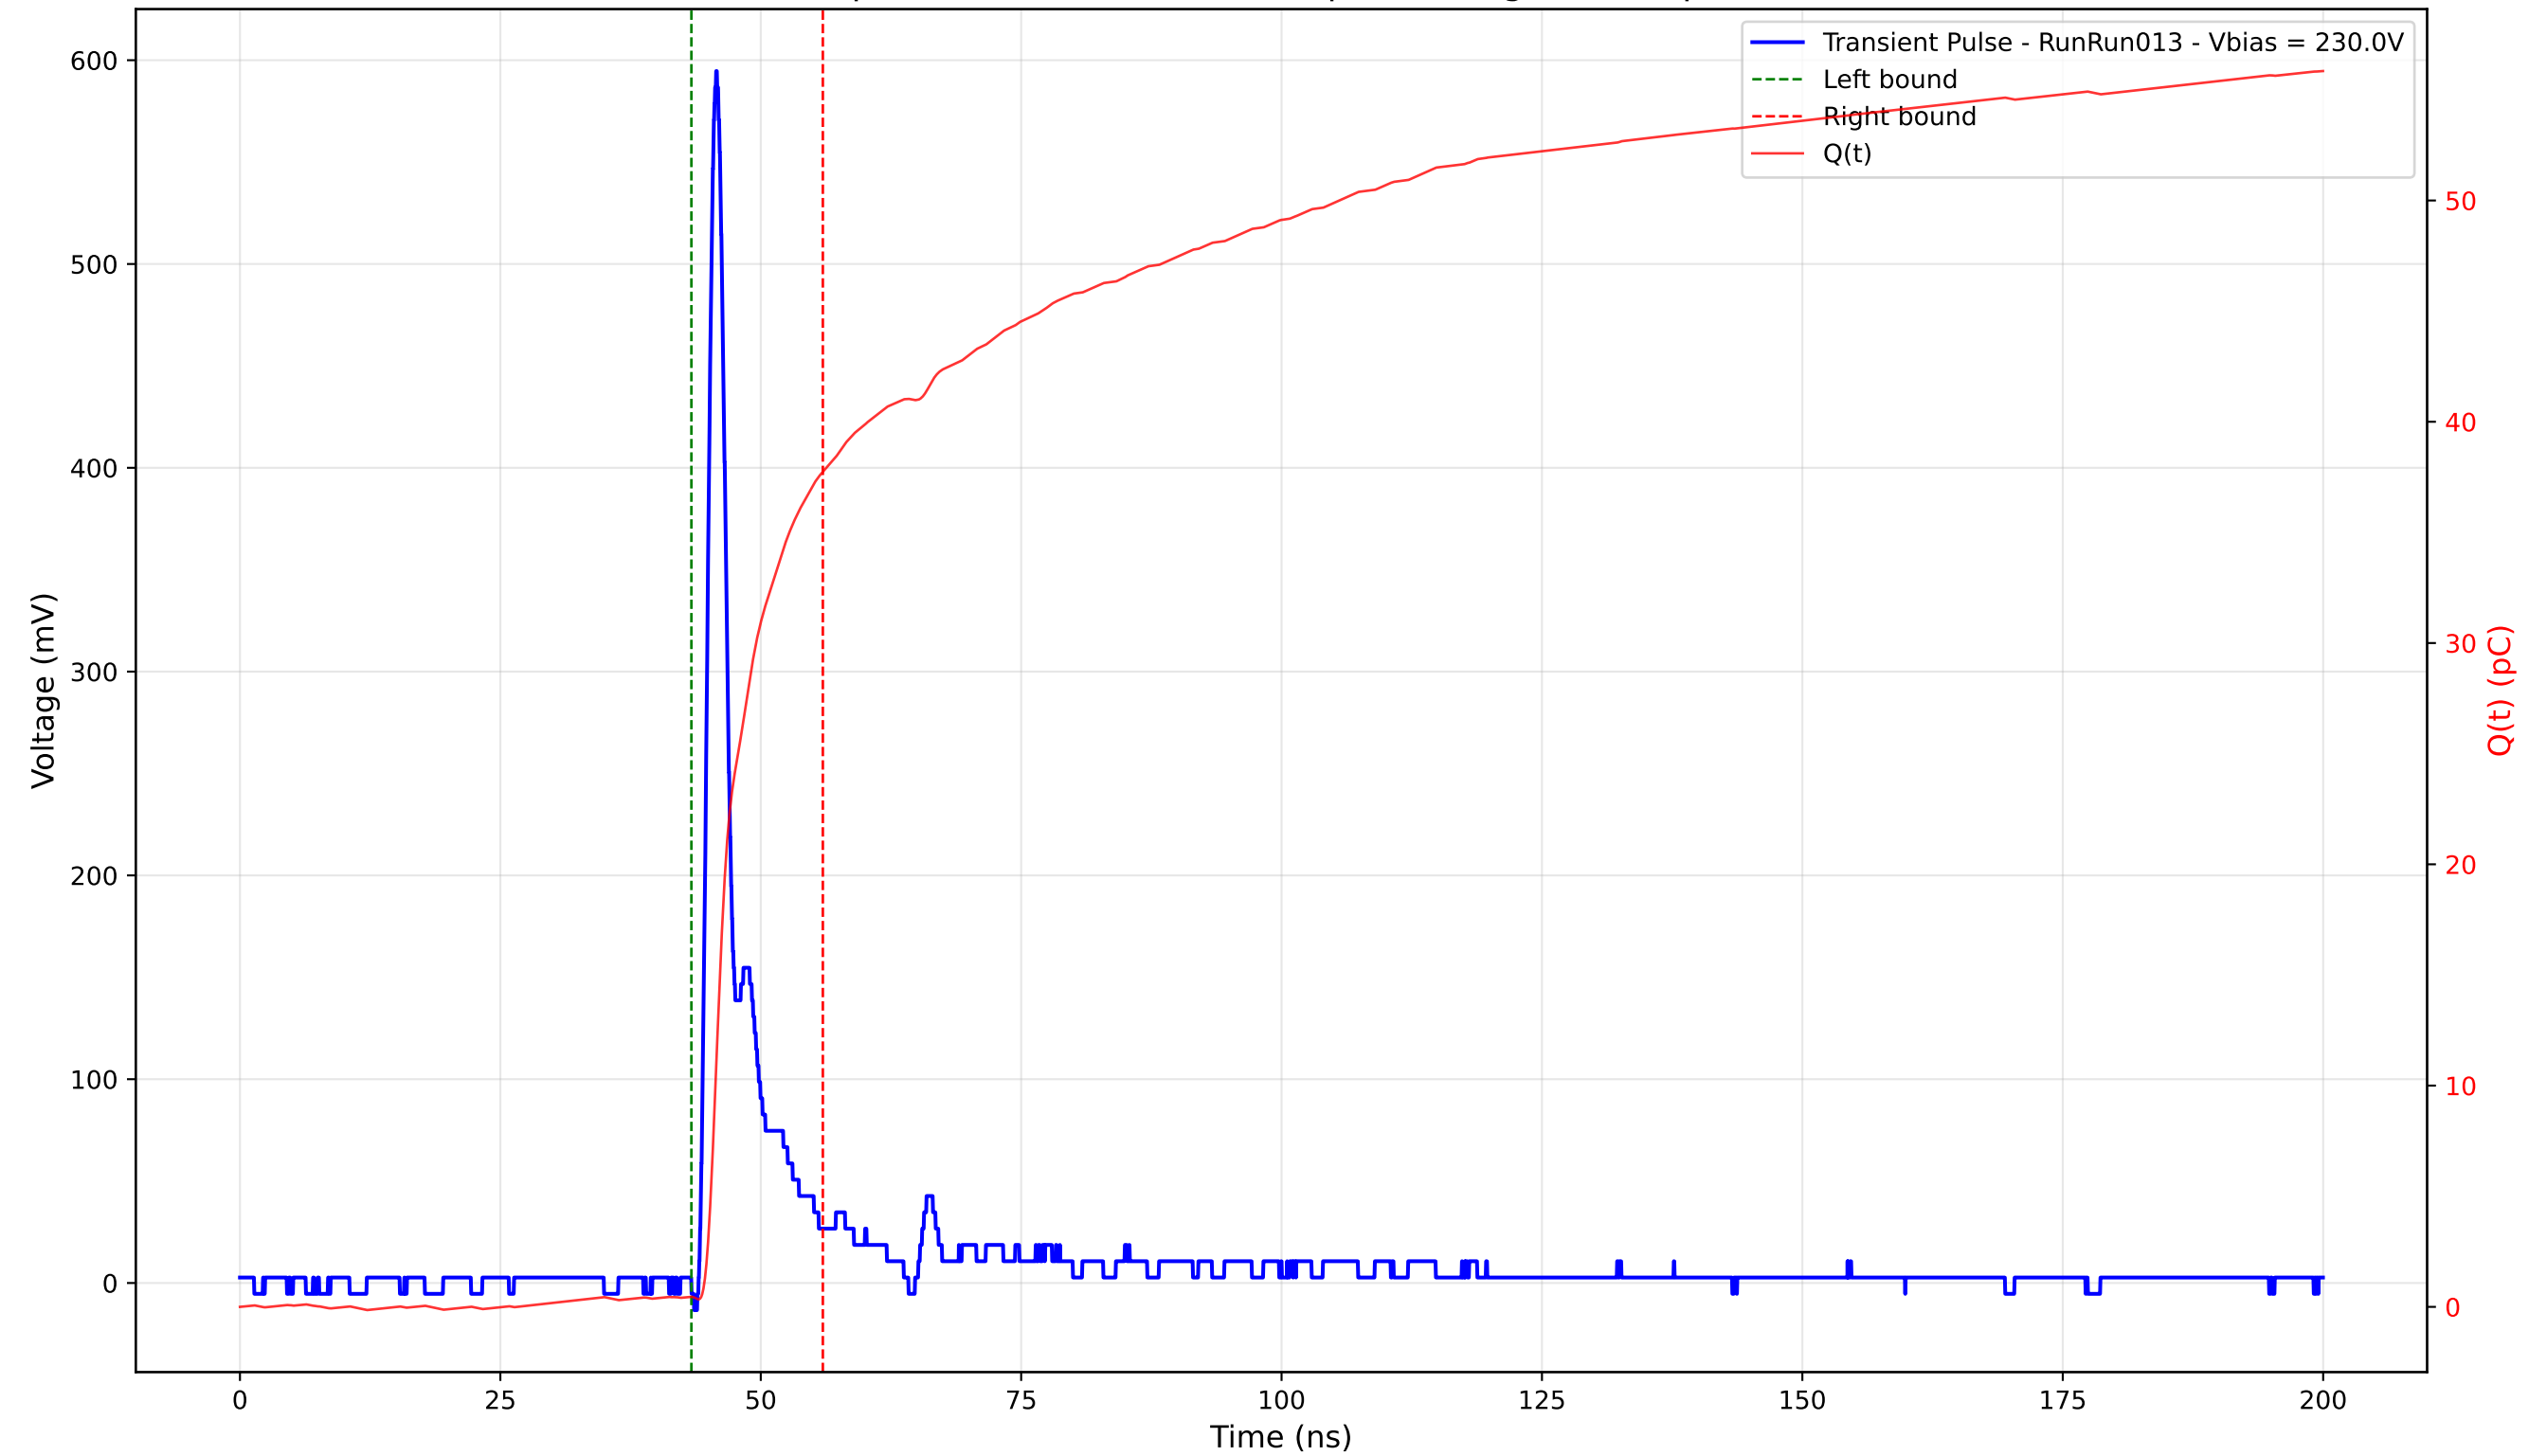


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 37.27 pC - Rise Time: 1.09 ns

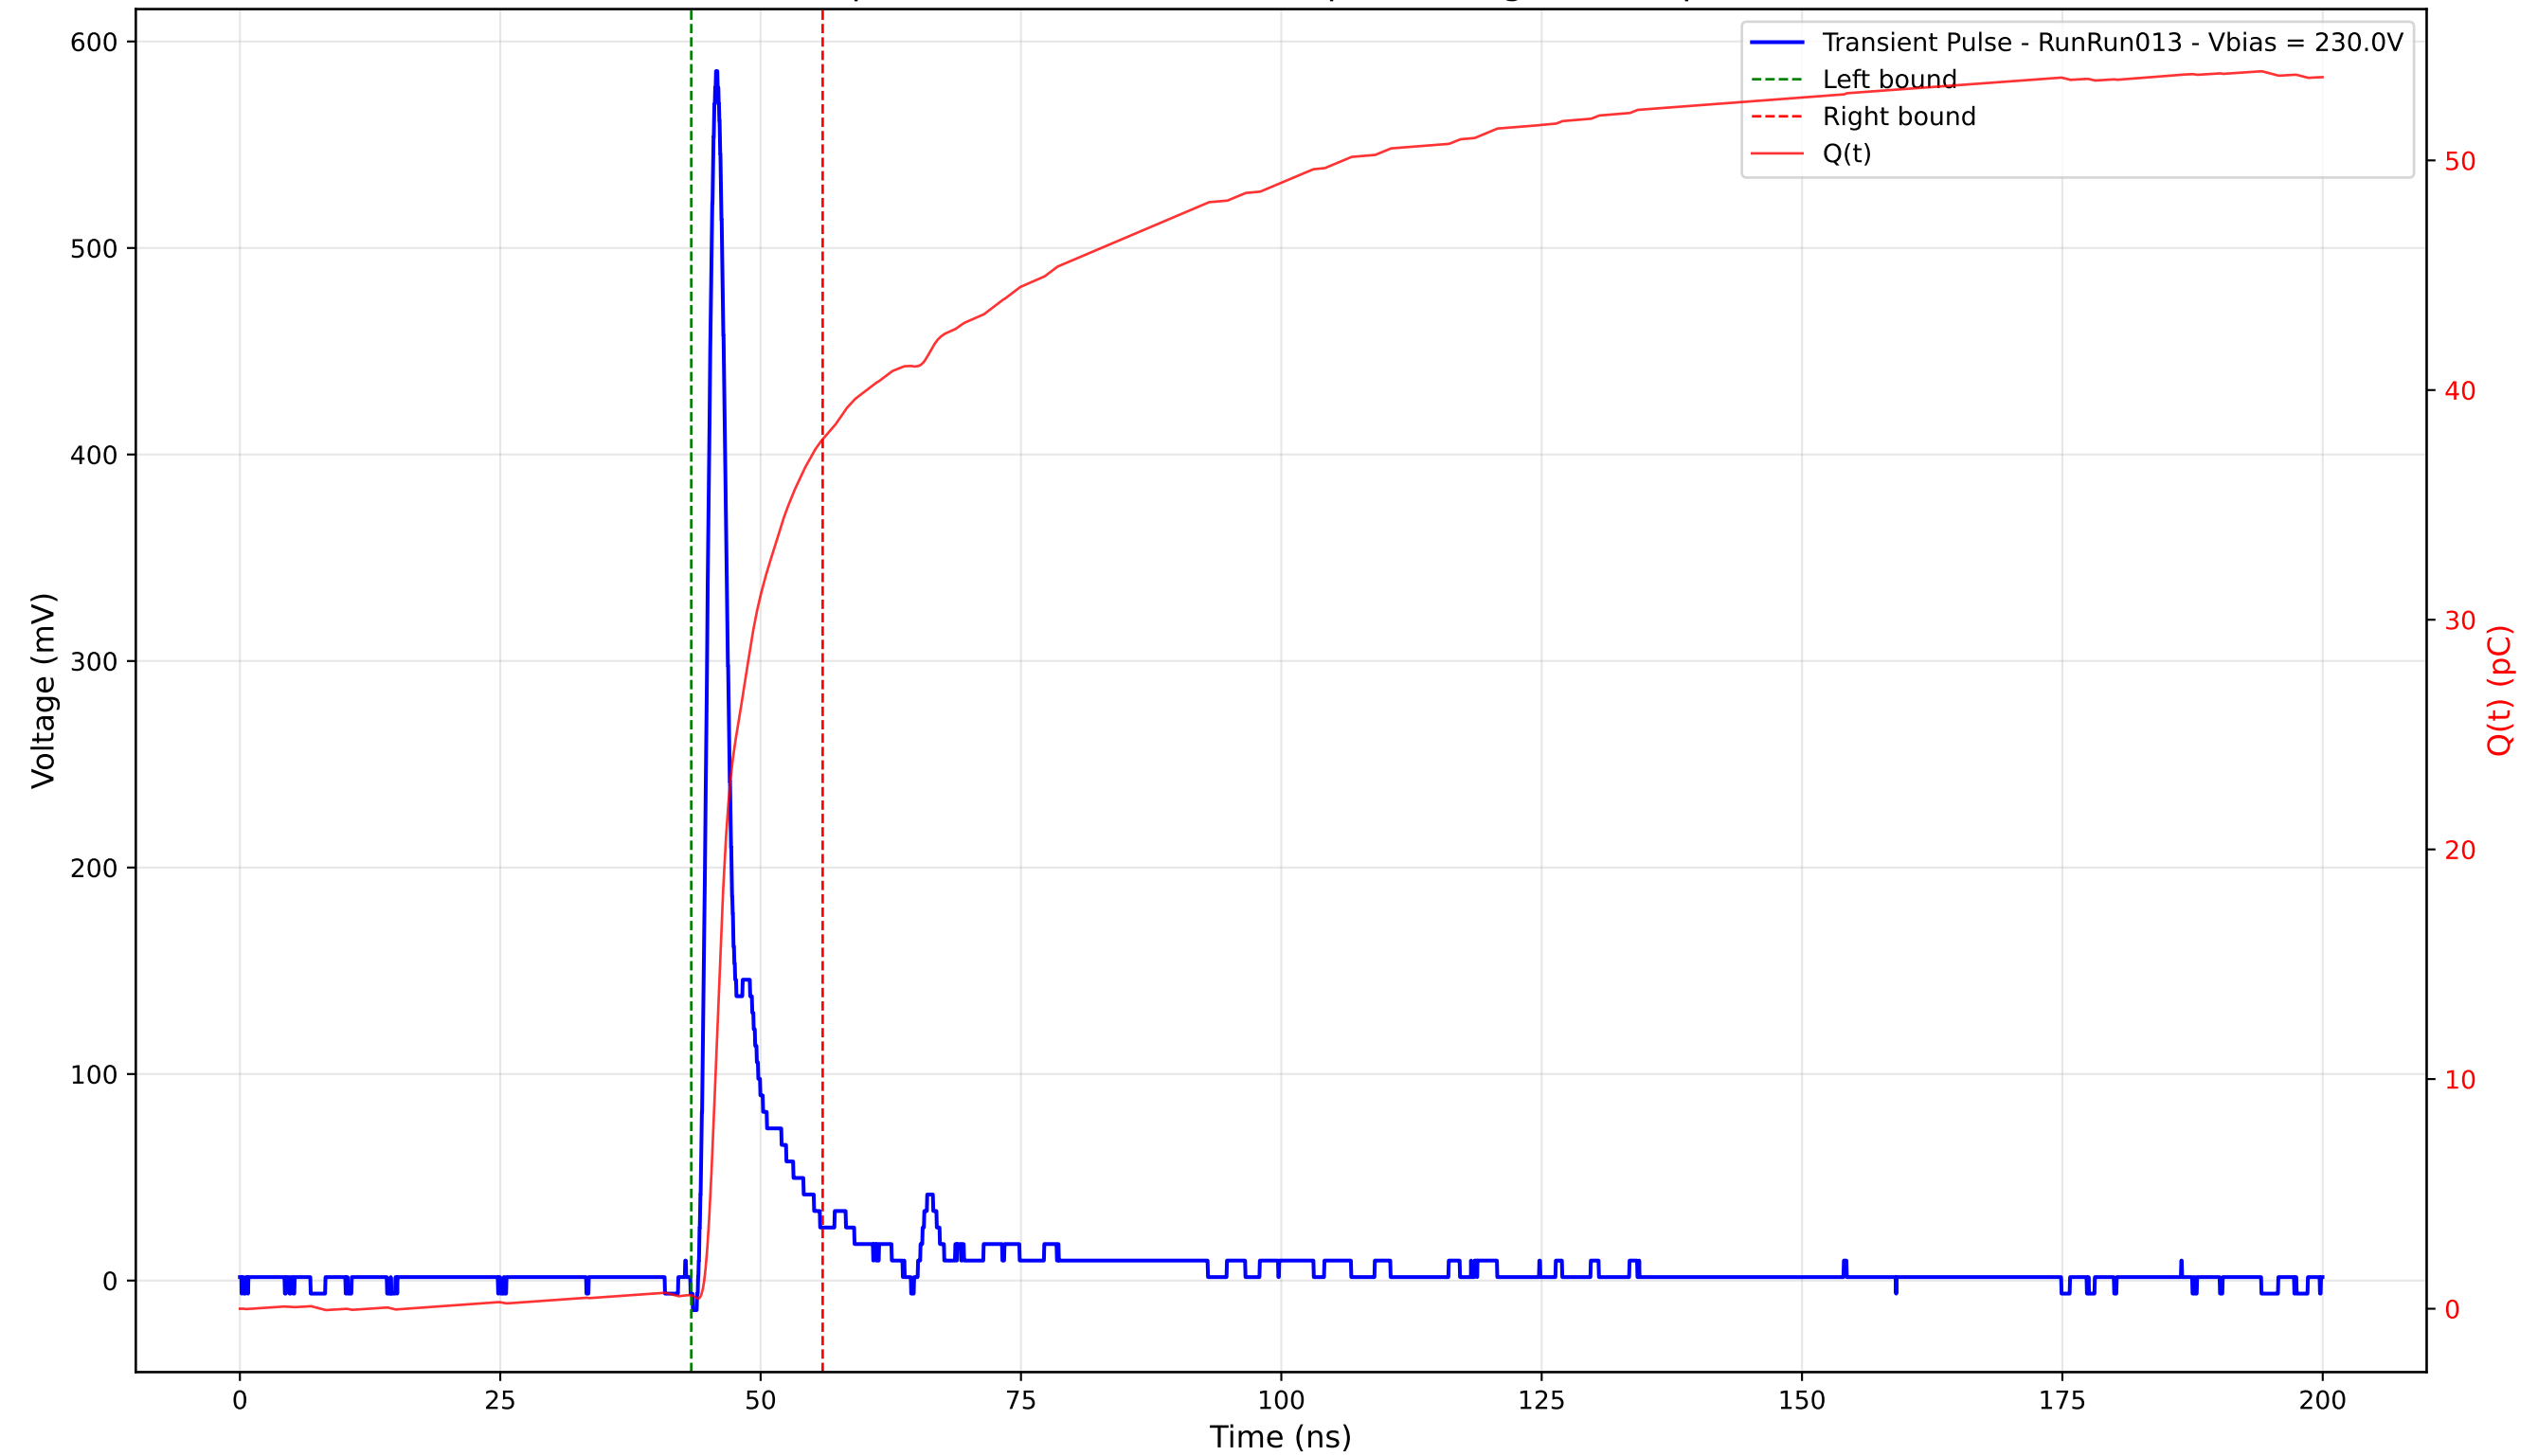


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 36.84 pC - Rise Time: 1.08 ns

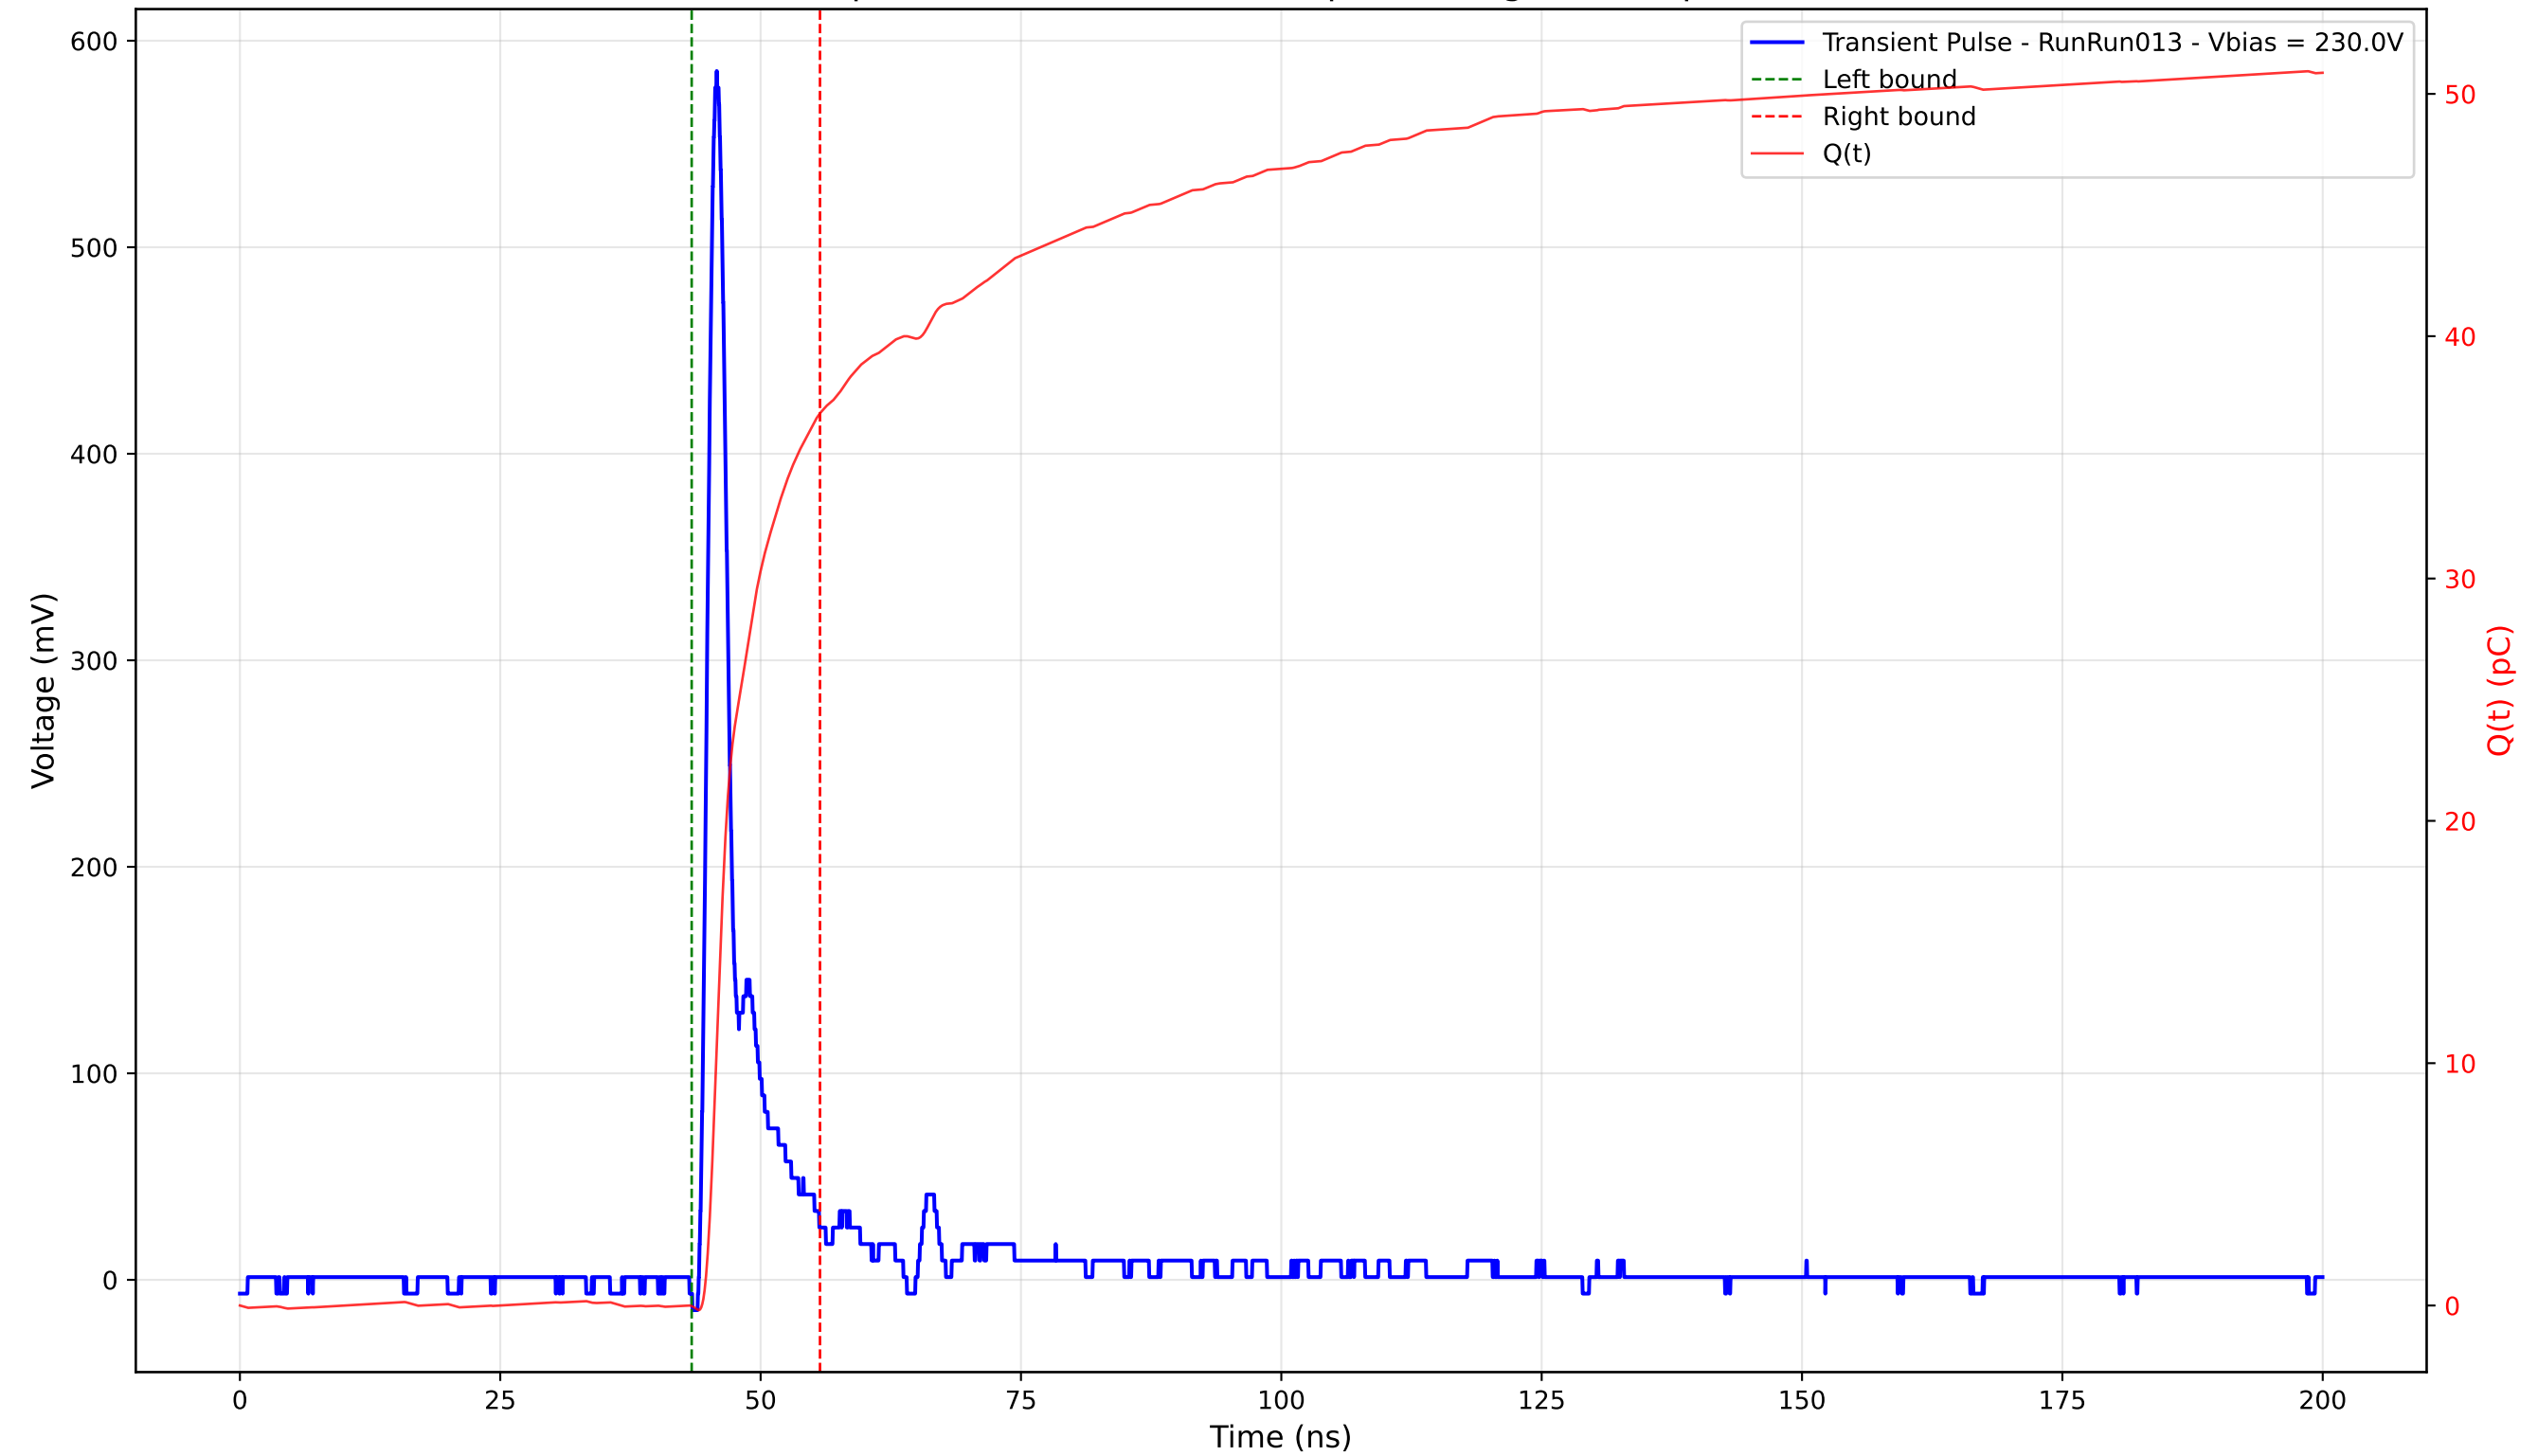


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 36.75 pC - Rise Time: 1.10 ns

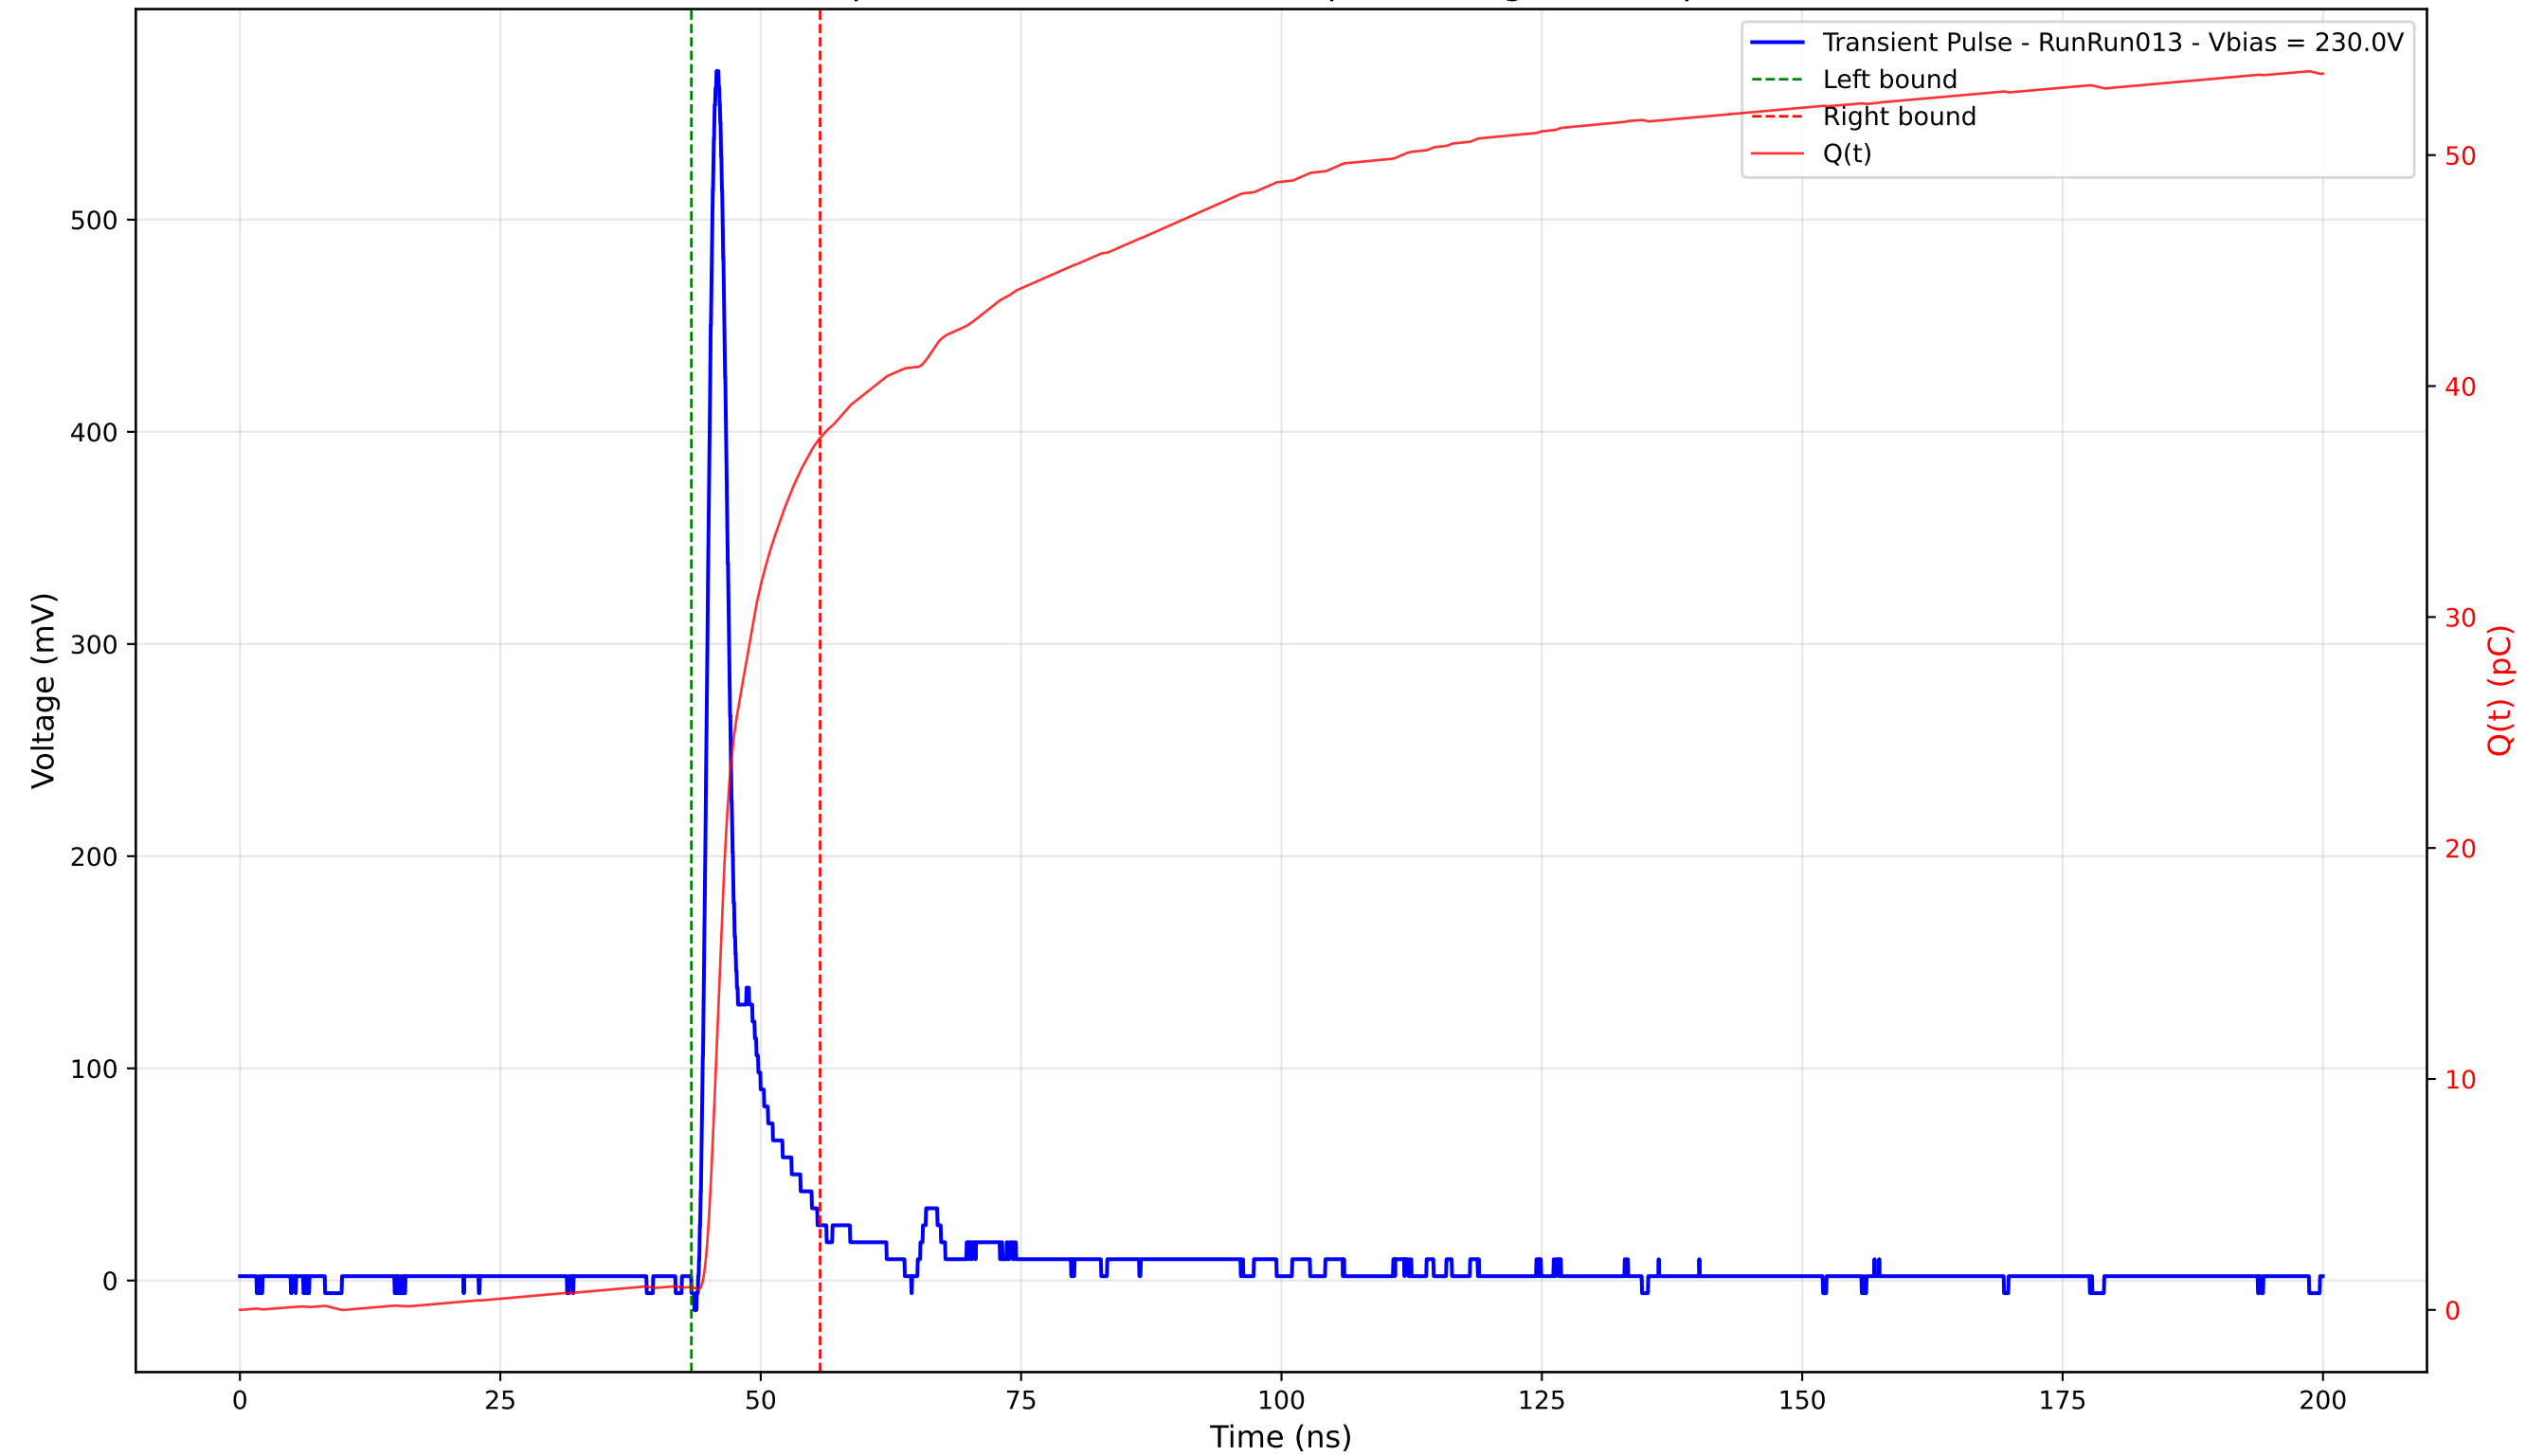


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 36.59 pC - Rise Time: 1.06 ns

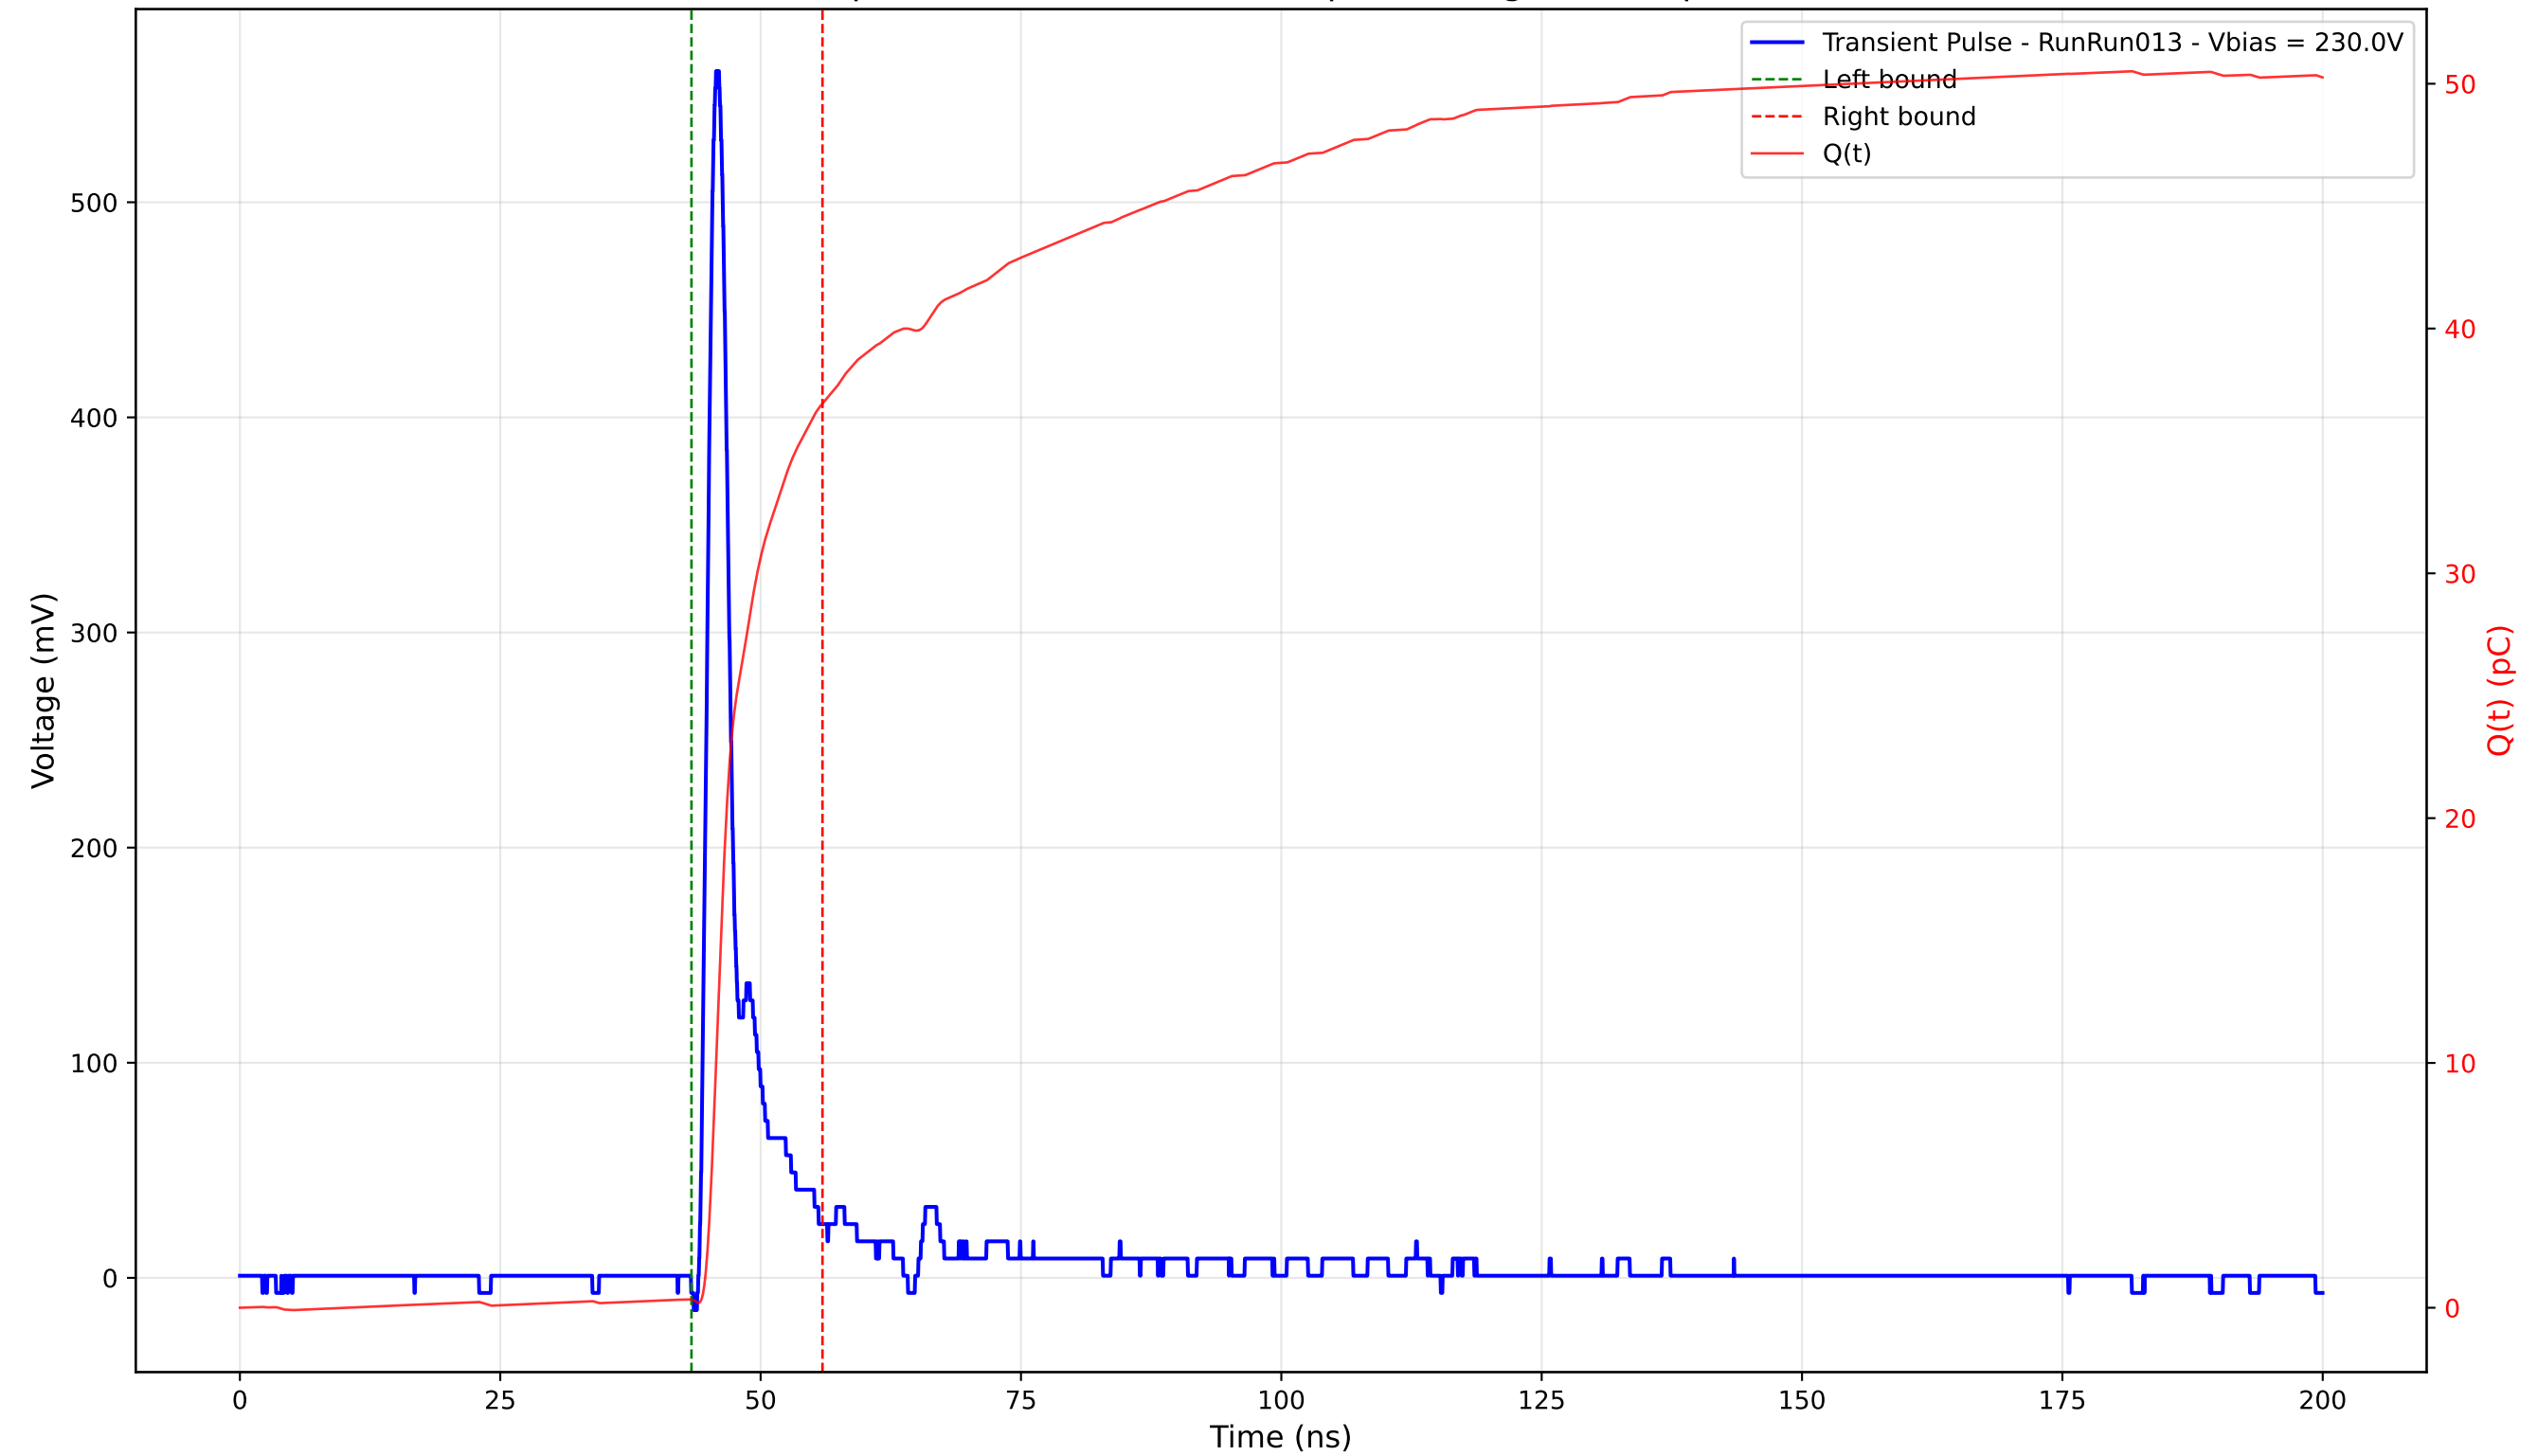


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 36.47 pC - Rise Time: 1.15 ns

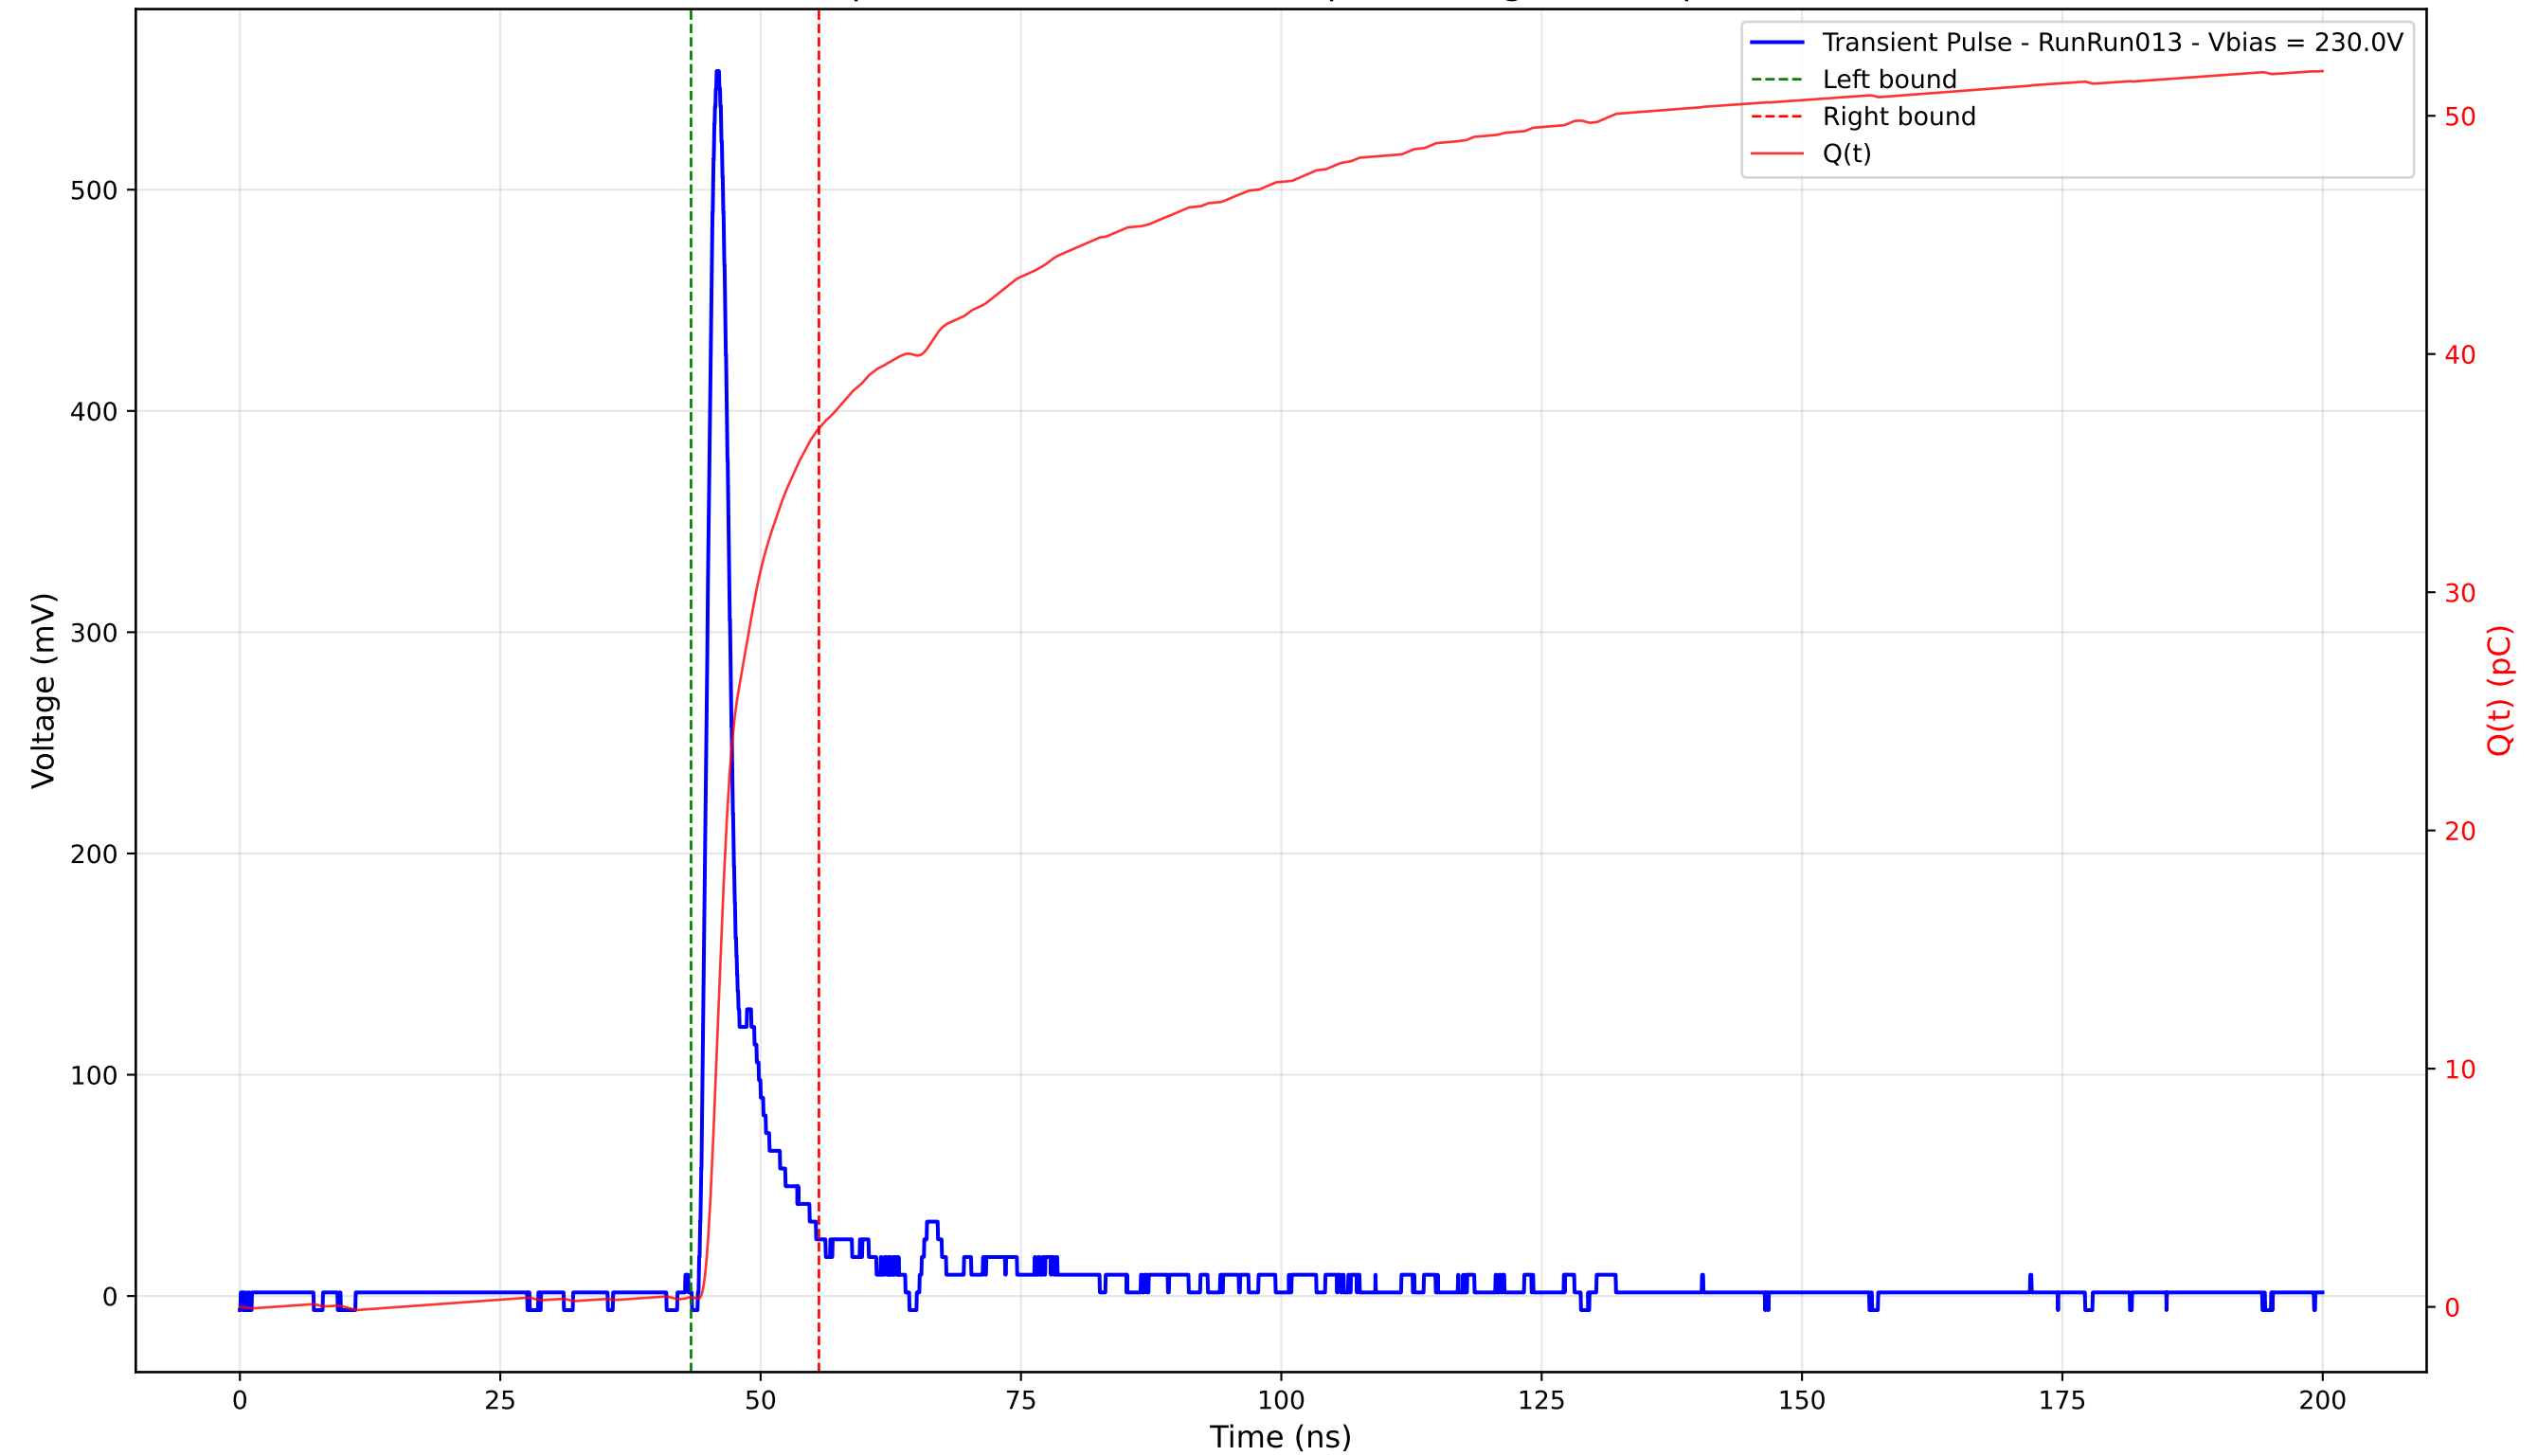


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 35.87 pC - Rise Time: 1.11 ns

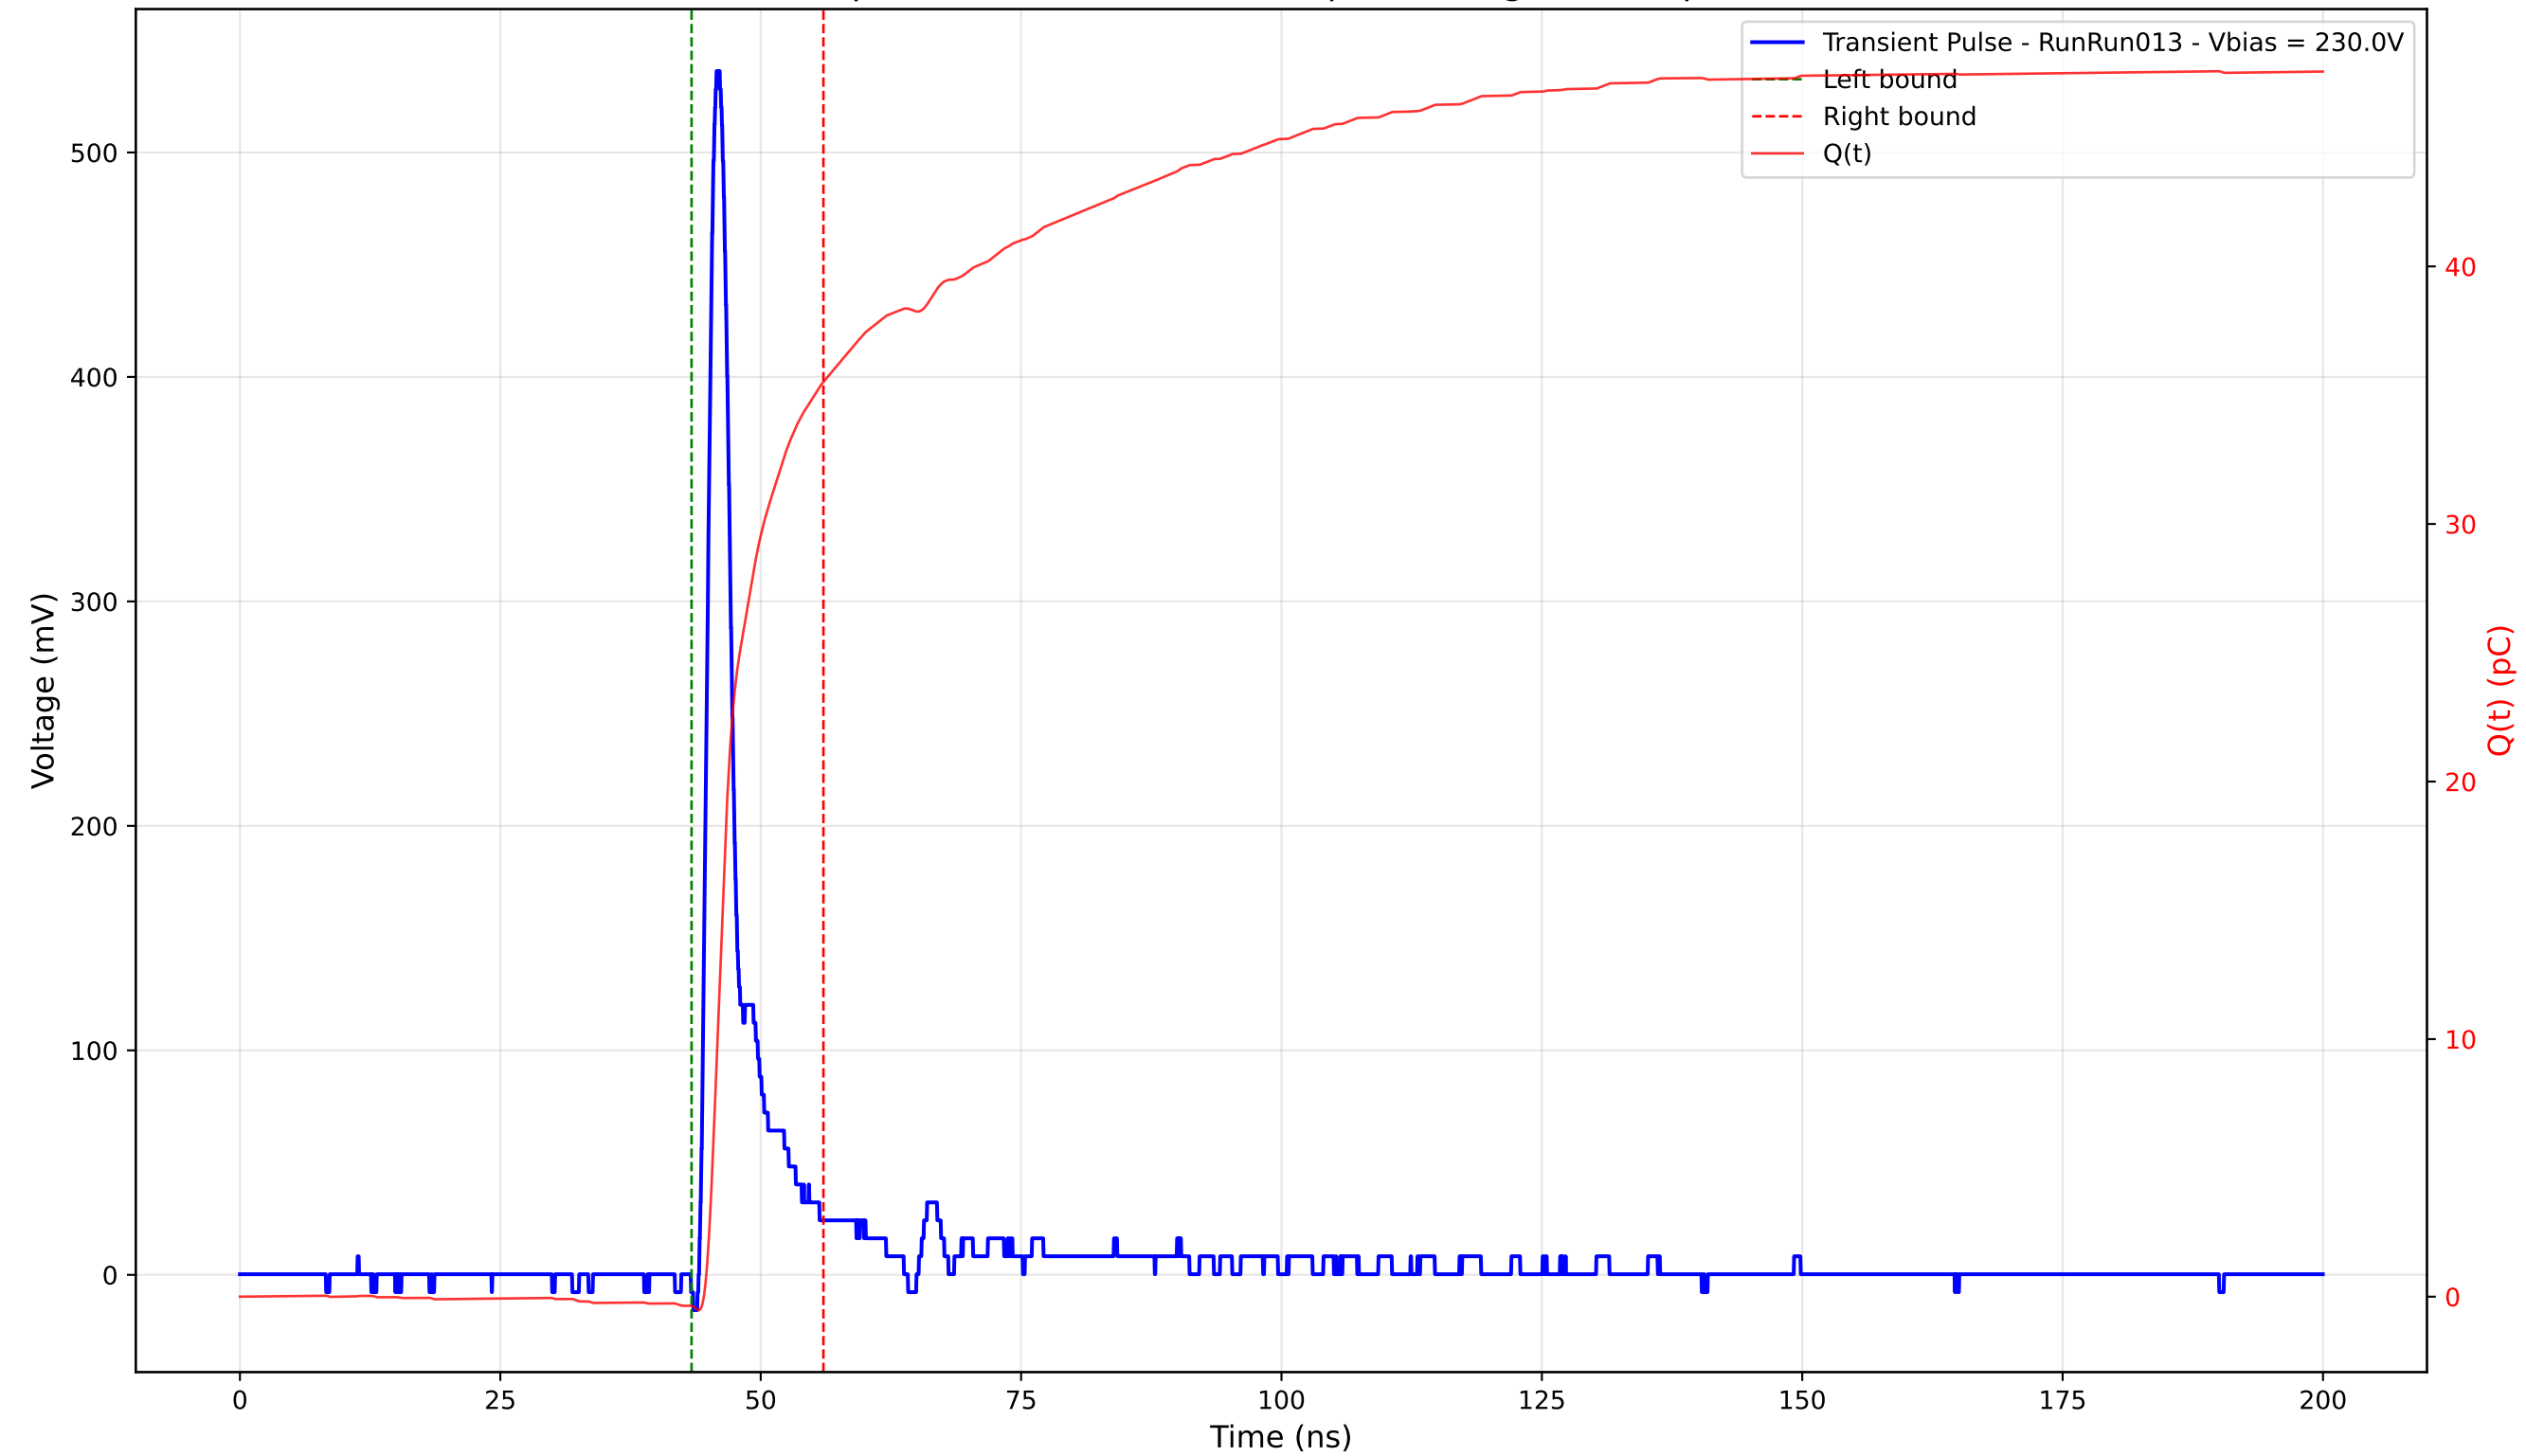


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 36.55 pC - Rise Time: 1.15 ns

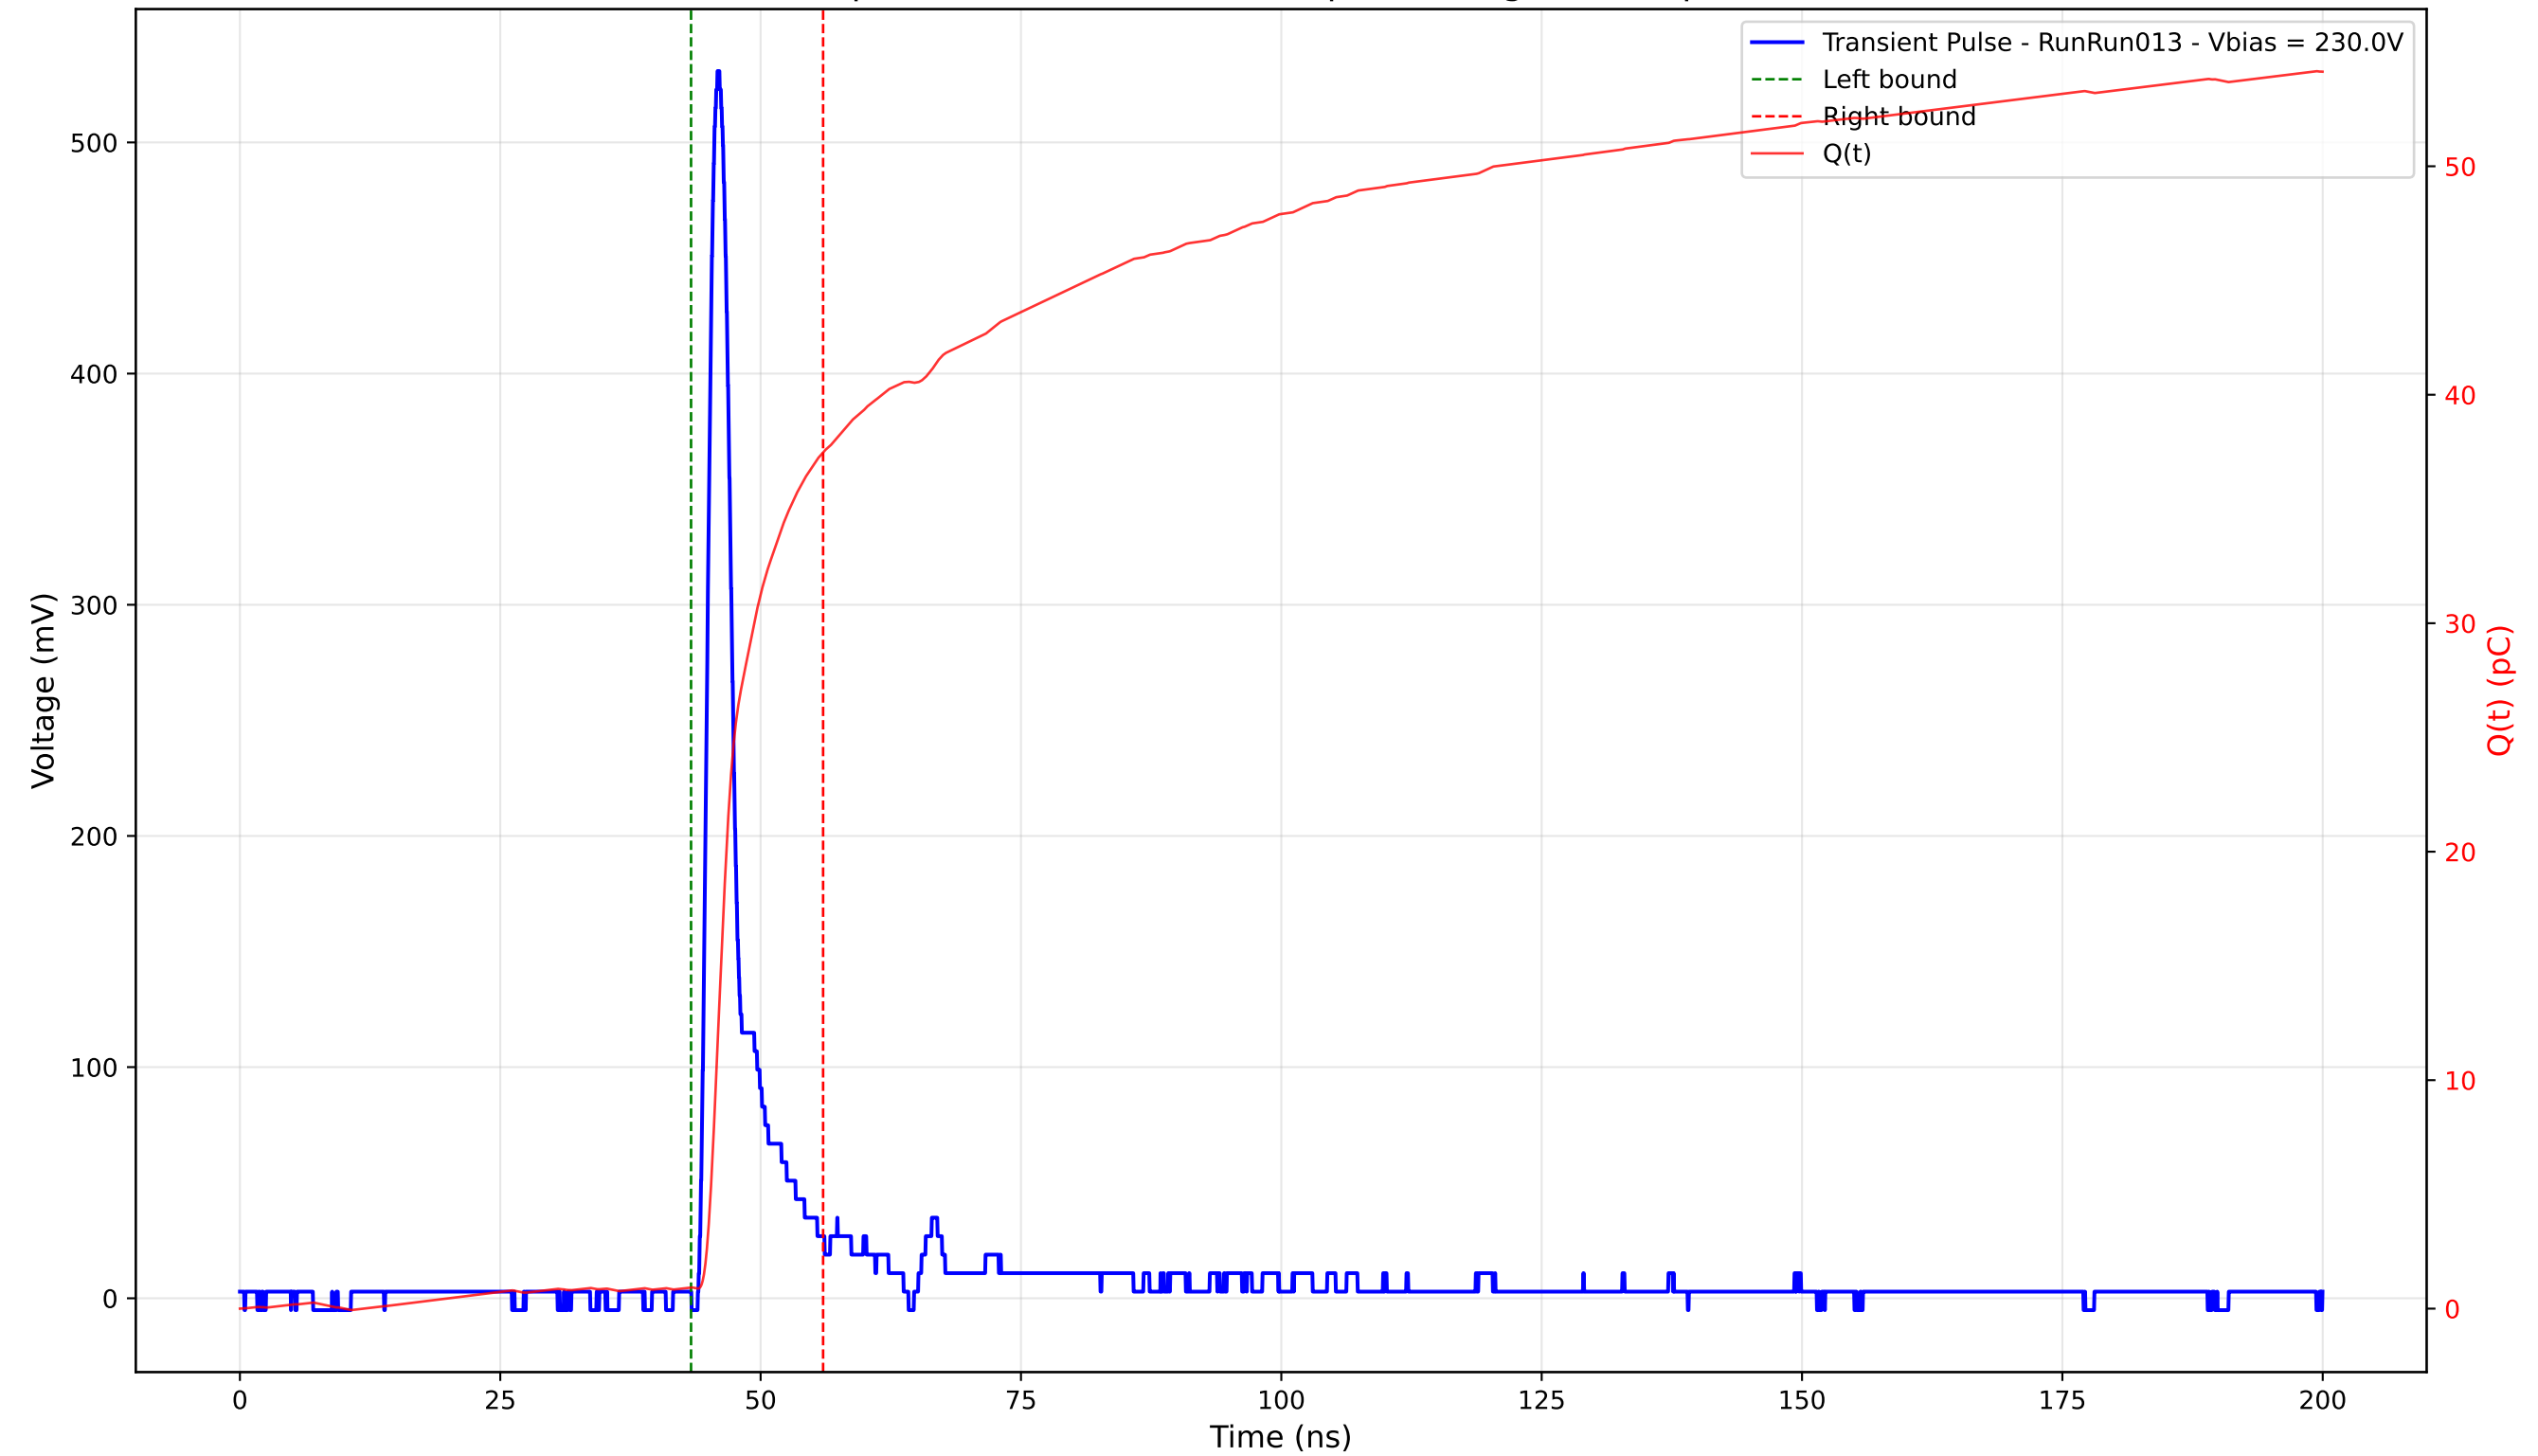


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 35.14 pC - Rise Time: 1.11 ns

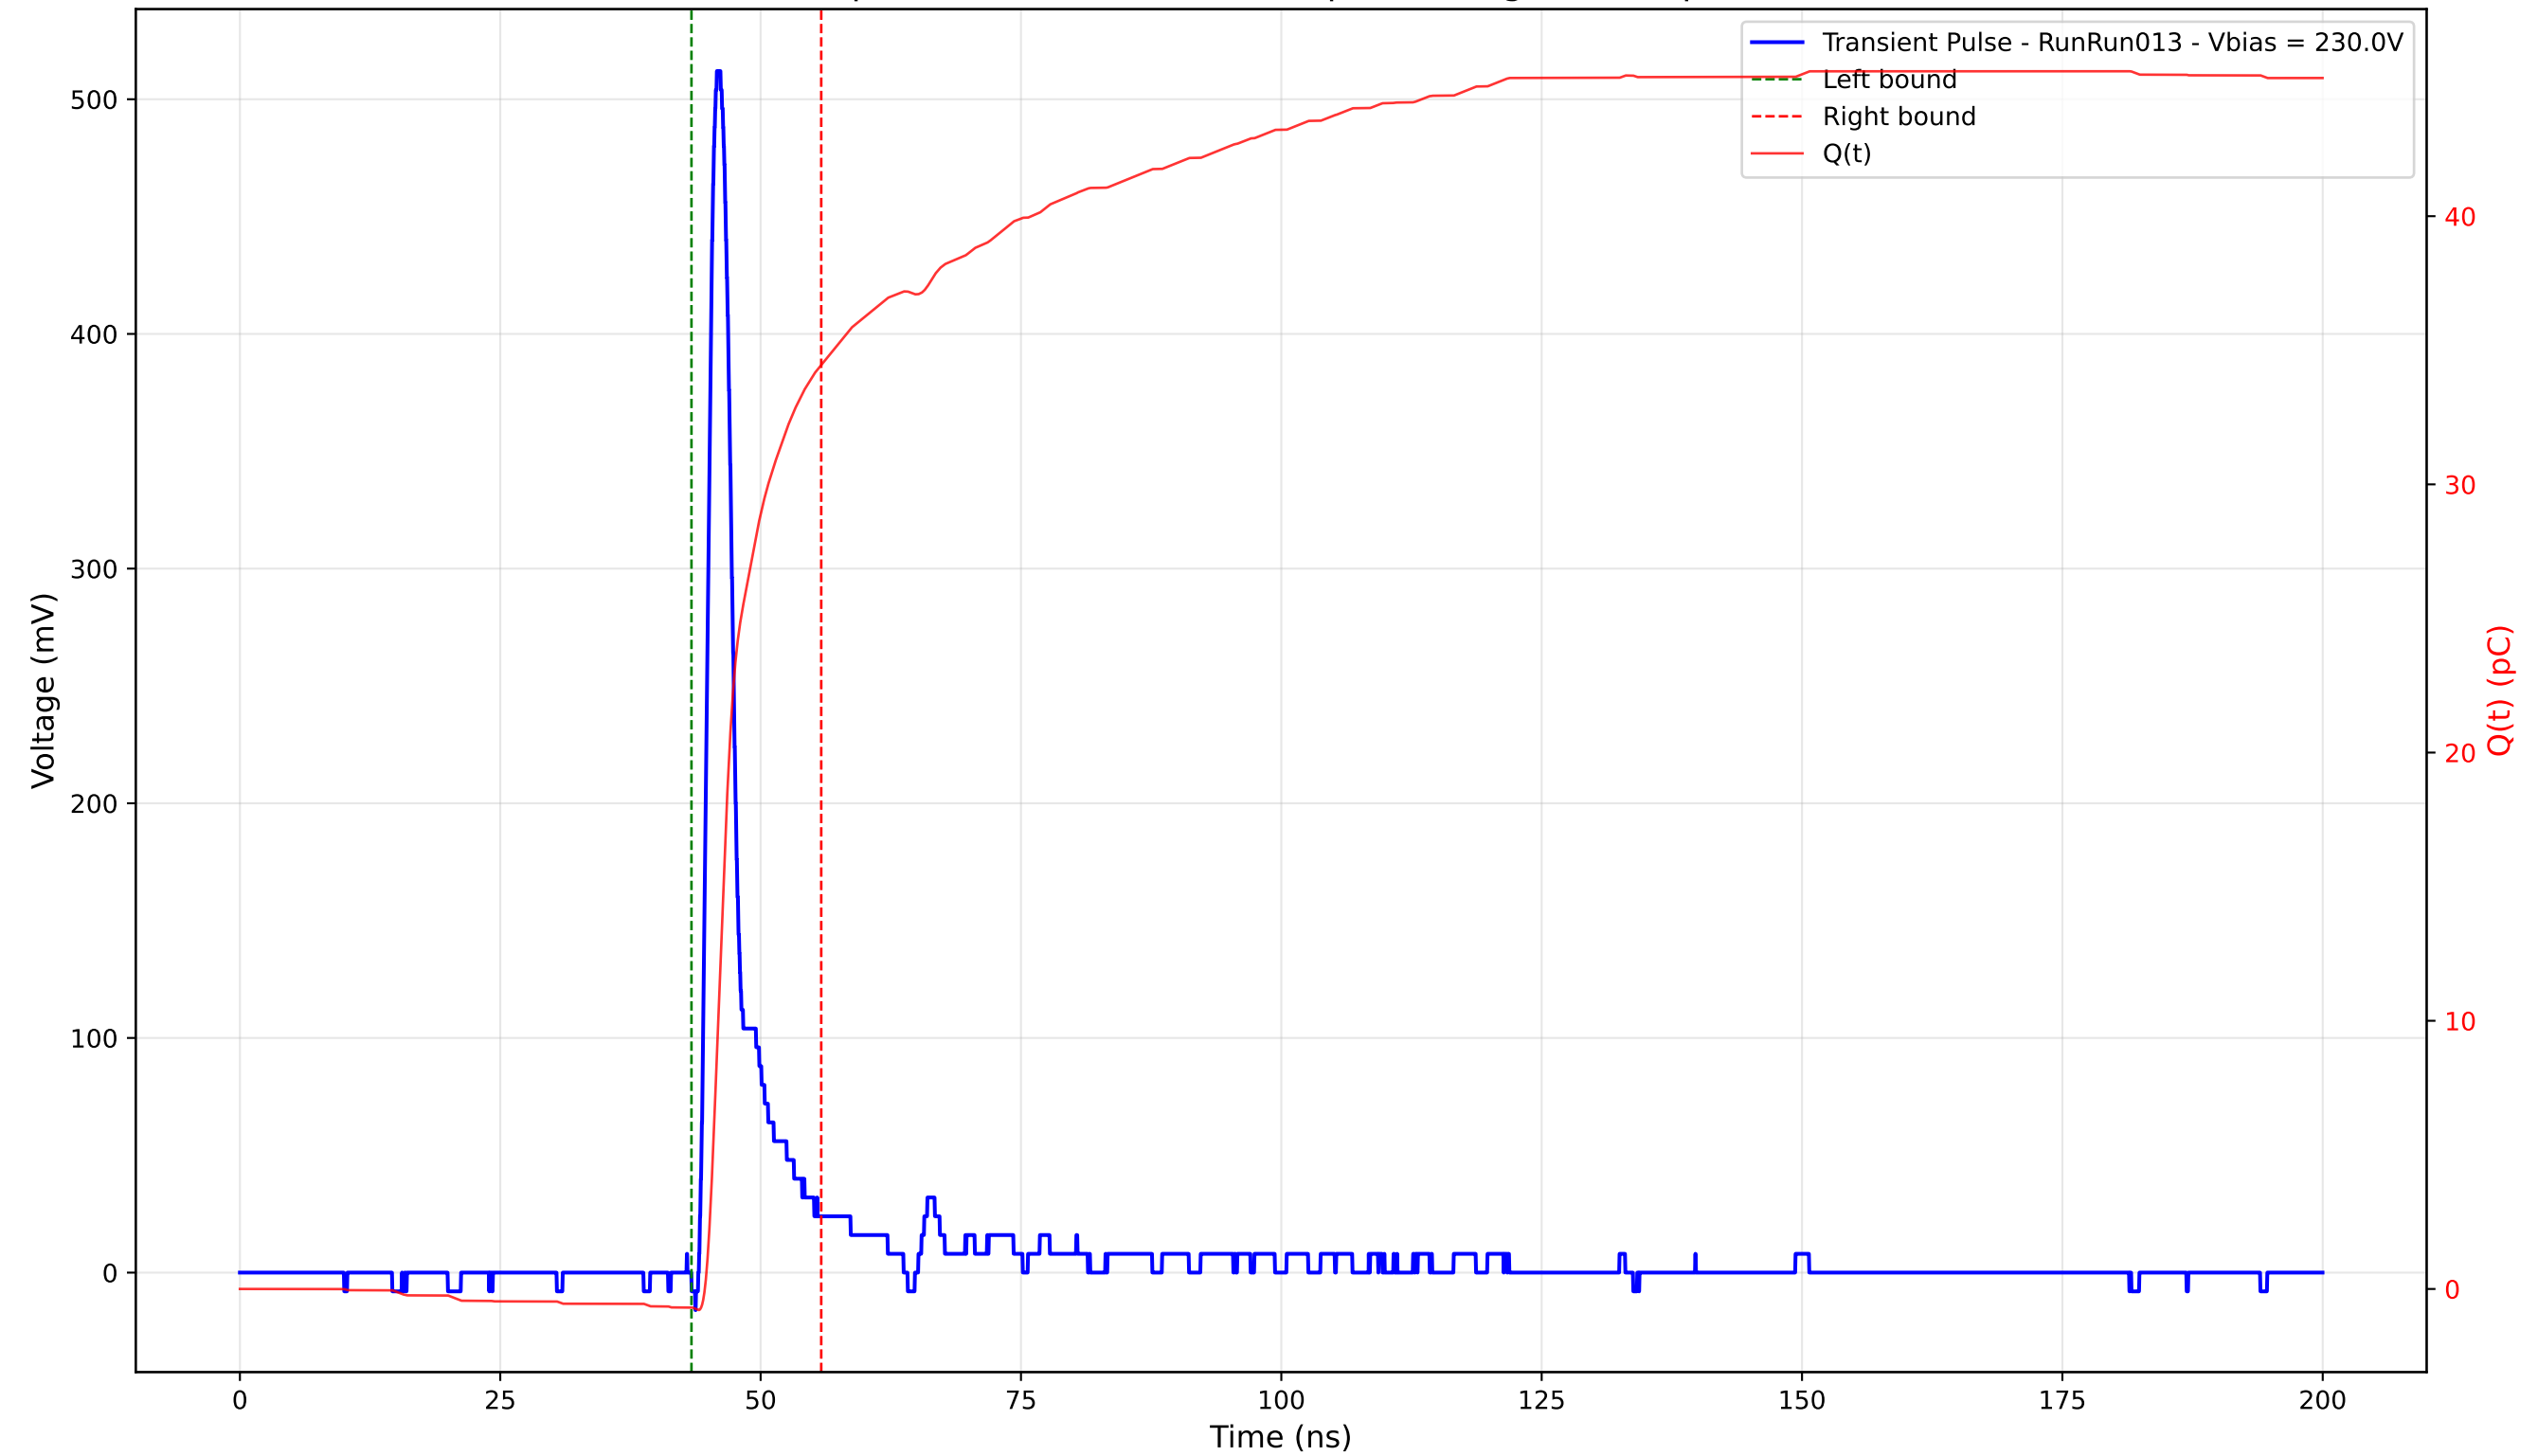


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 36.47 pC - Rise Time: 1.16 ns

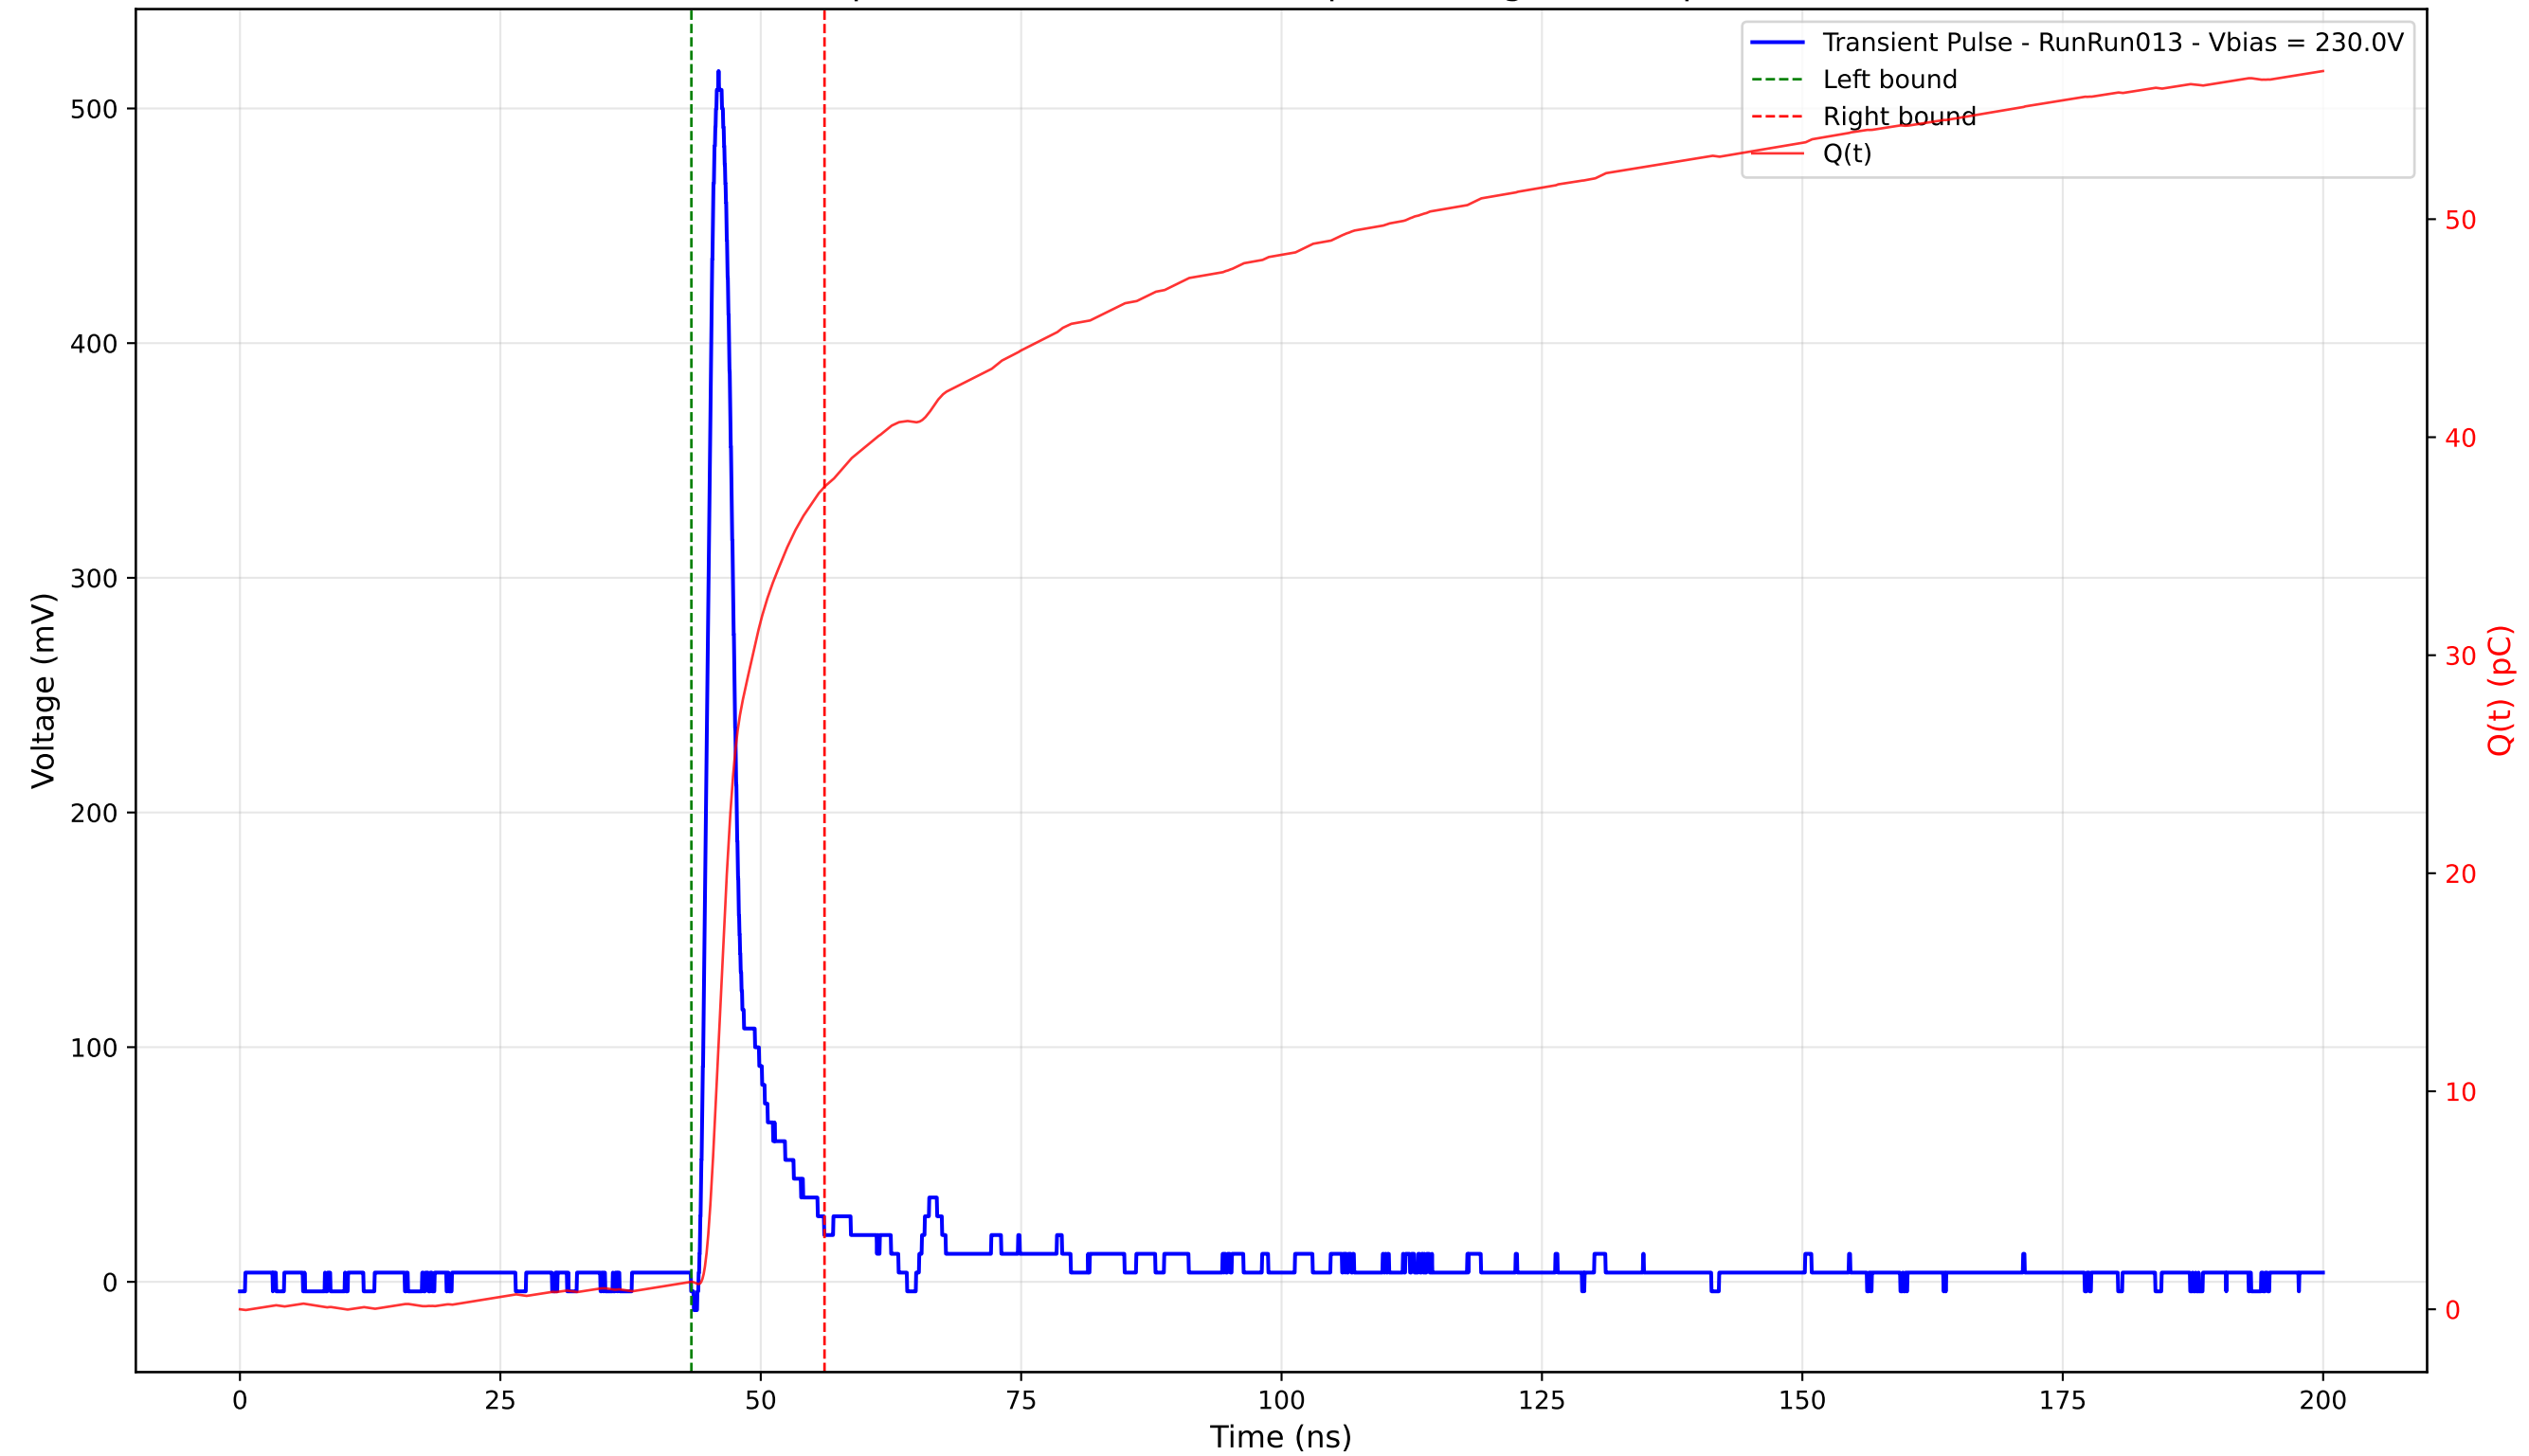


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 36.98 pC - Rise Time: 1.16 ns

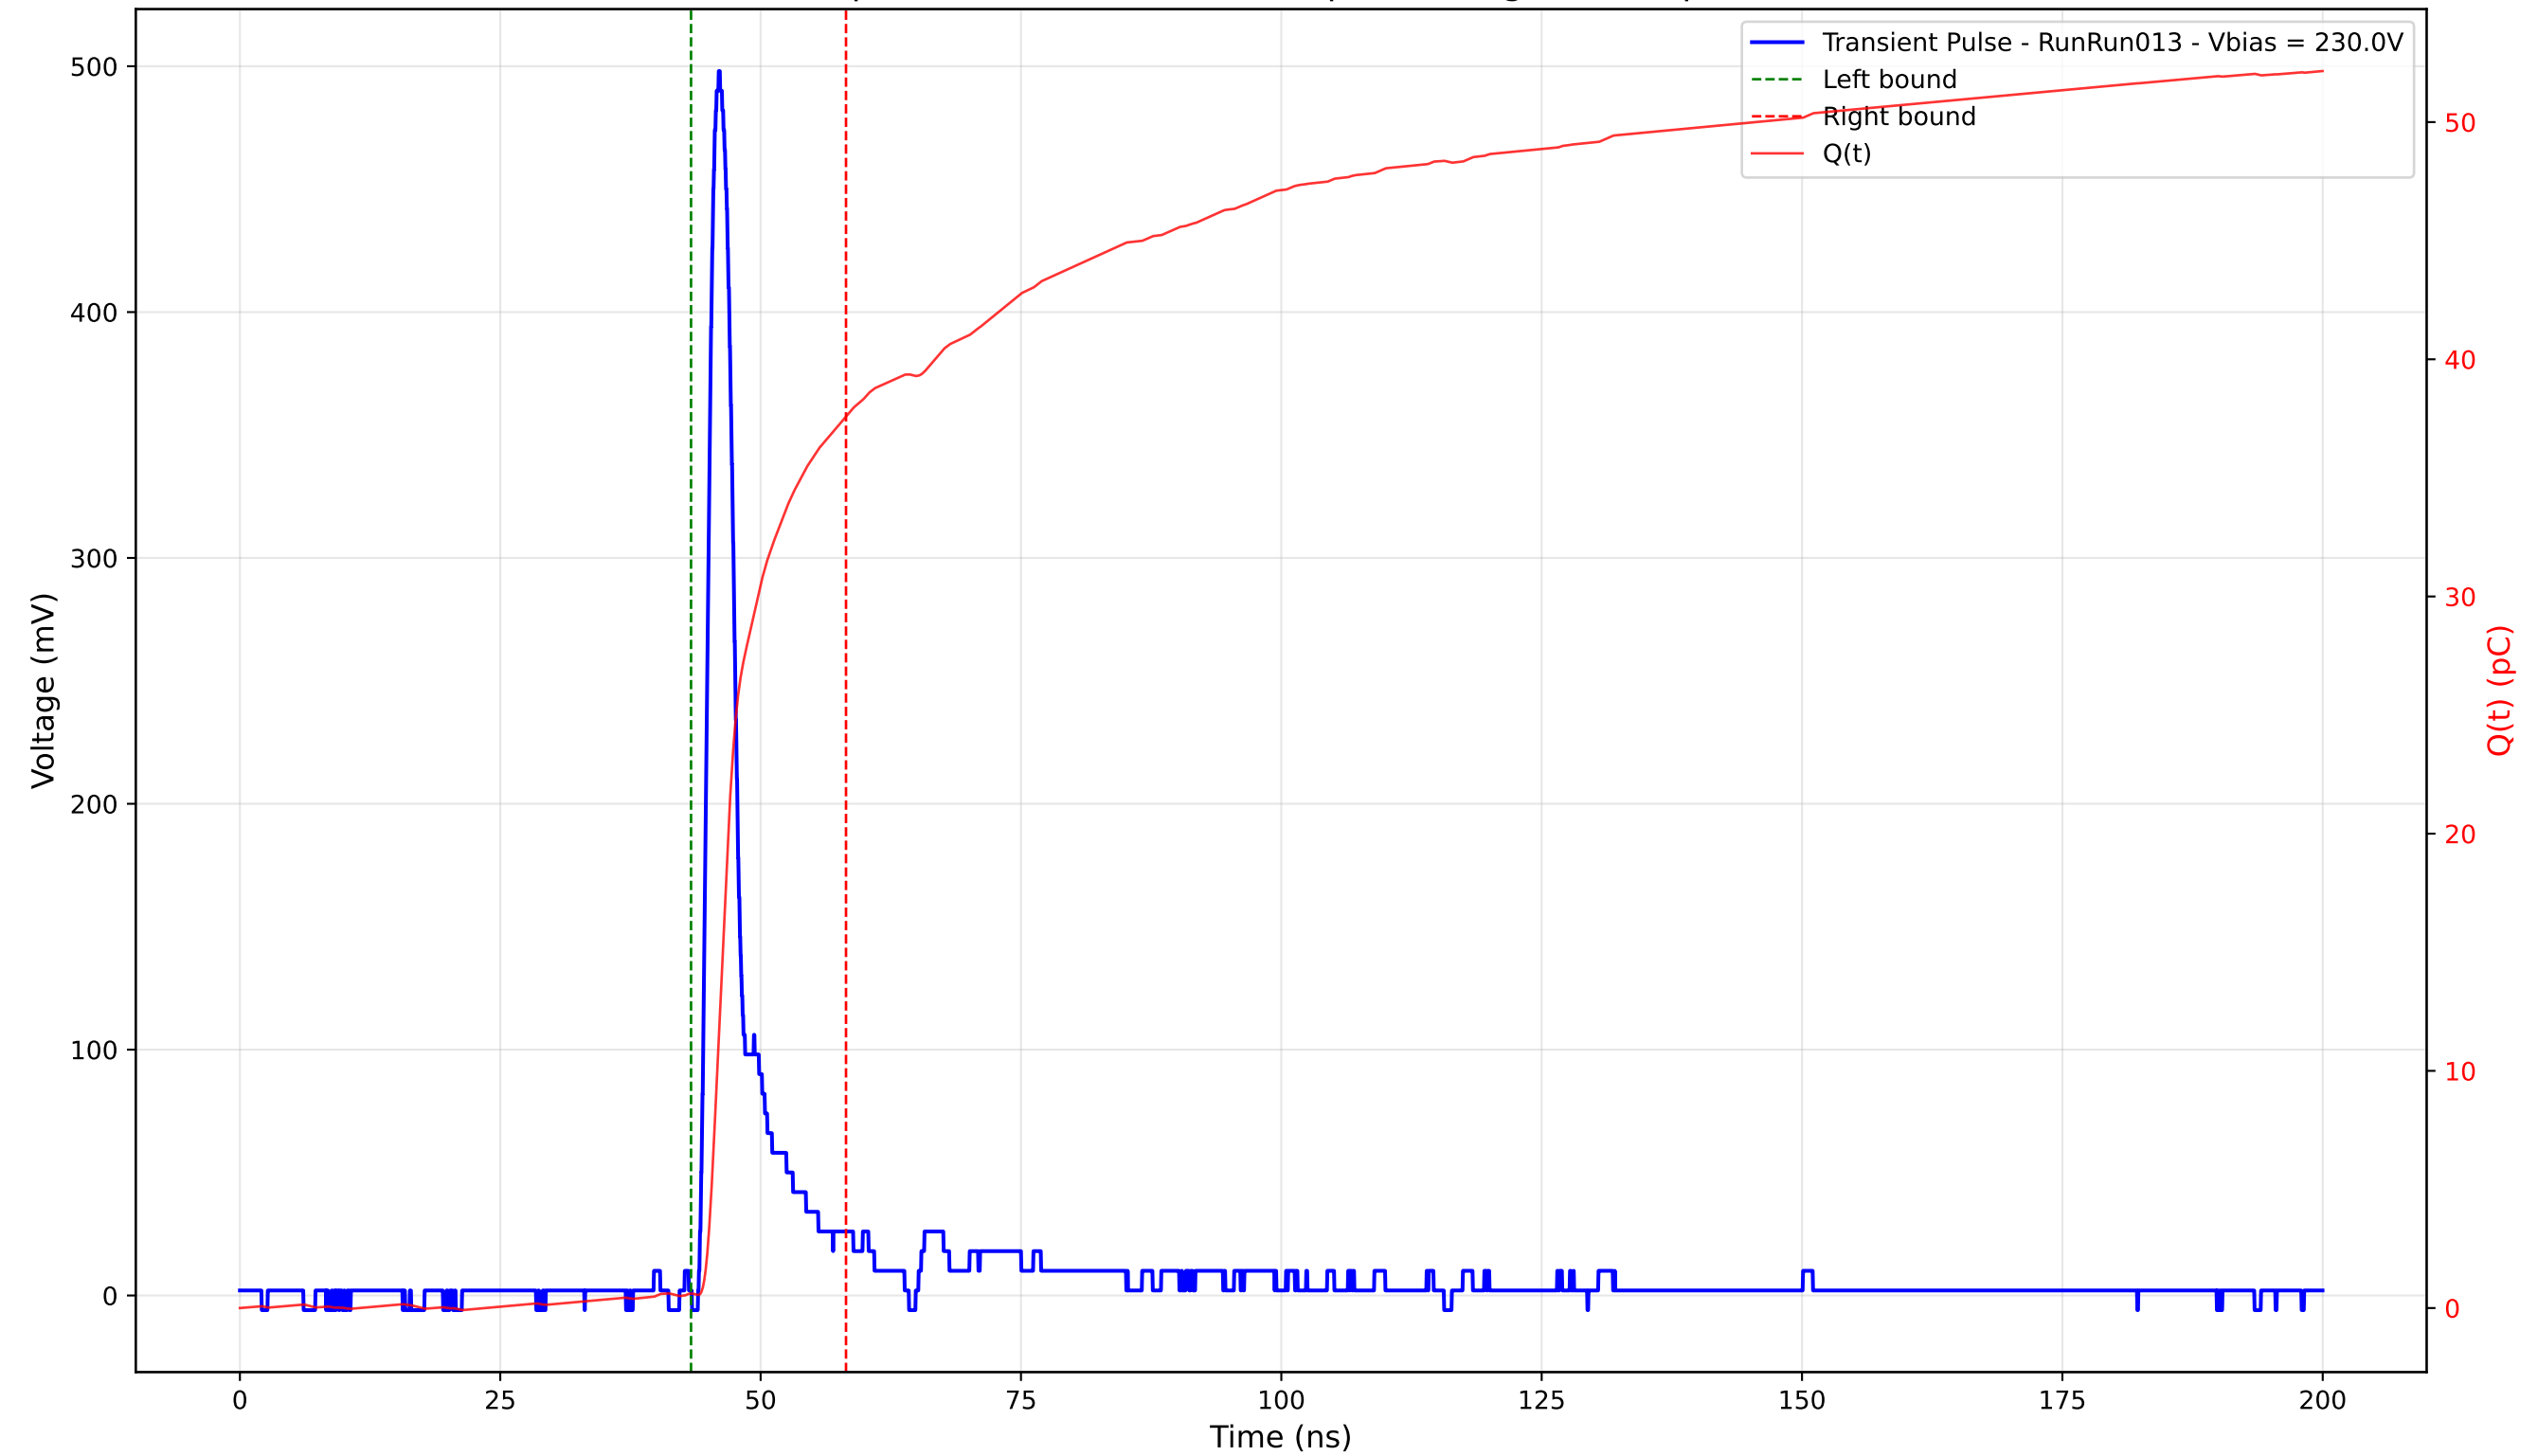


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 35.60 pC - Rise Time: 1.14 ns

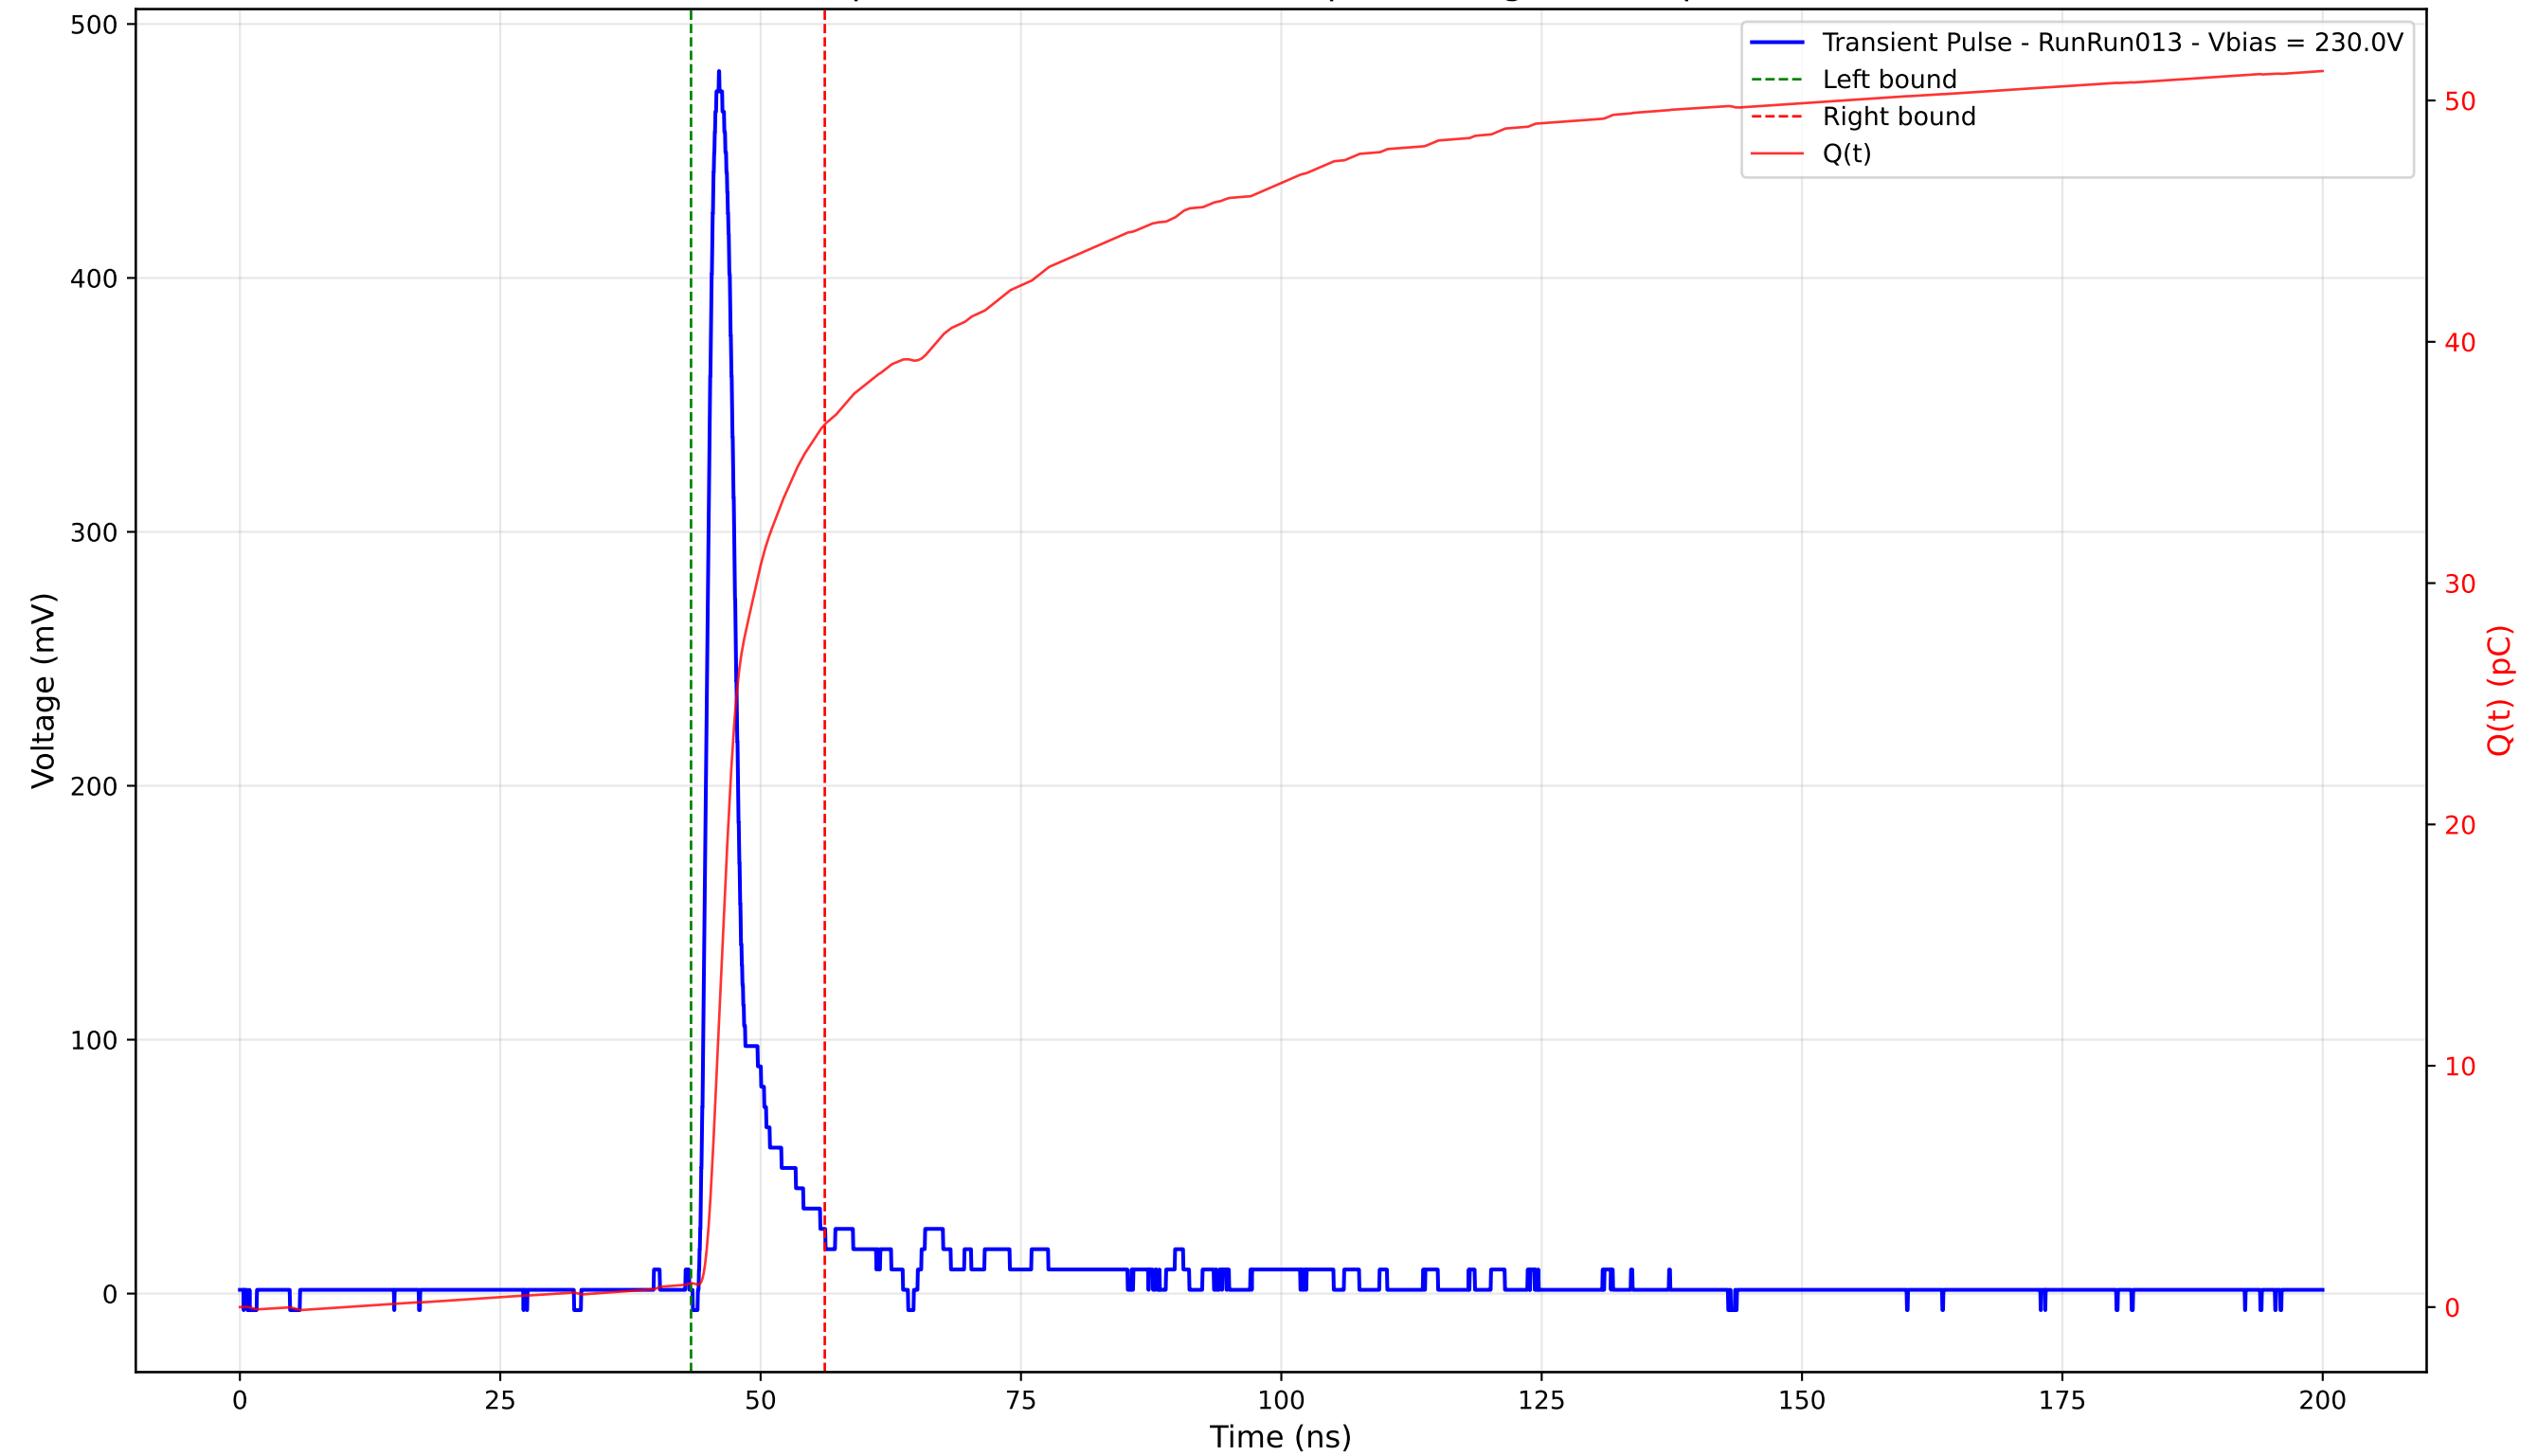


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 35.34 pC - Rise Time: 1.19 ns

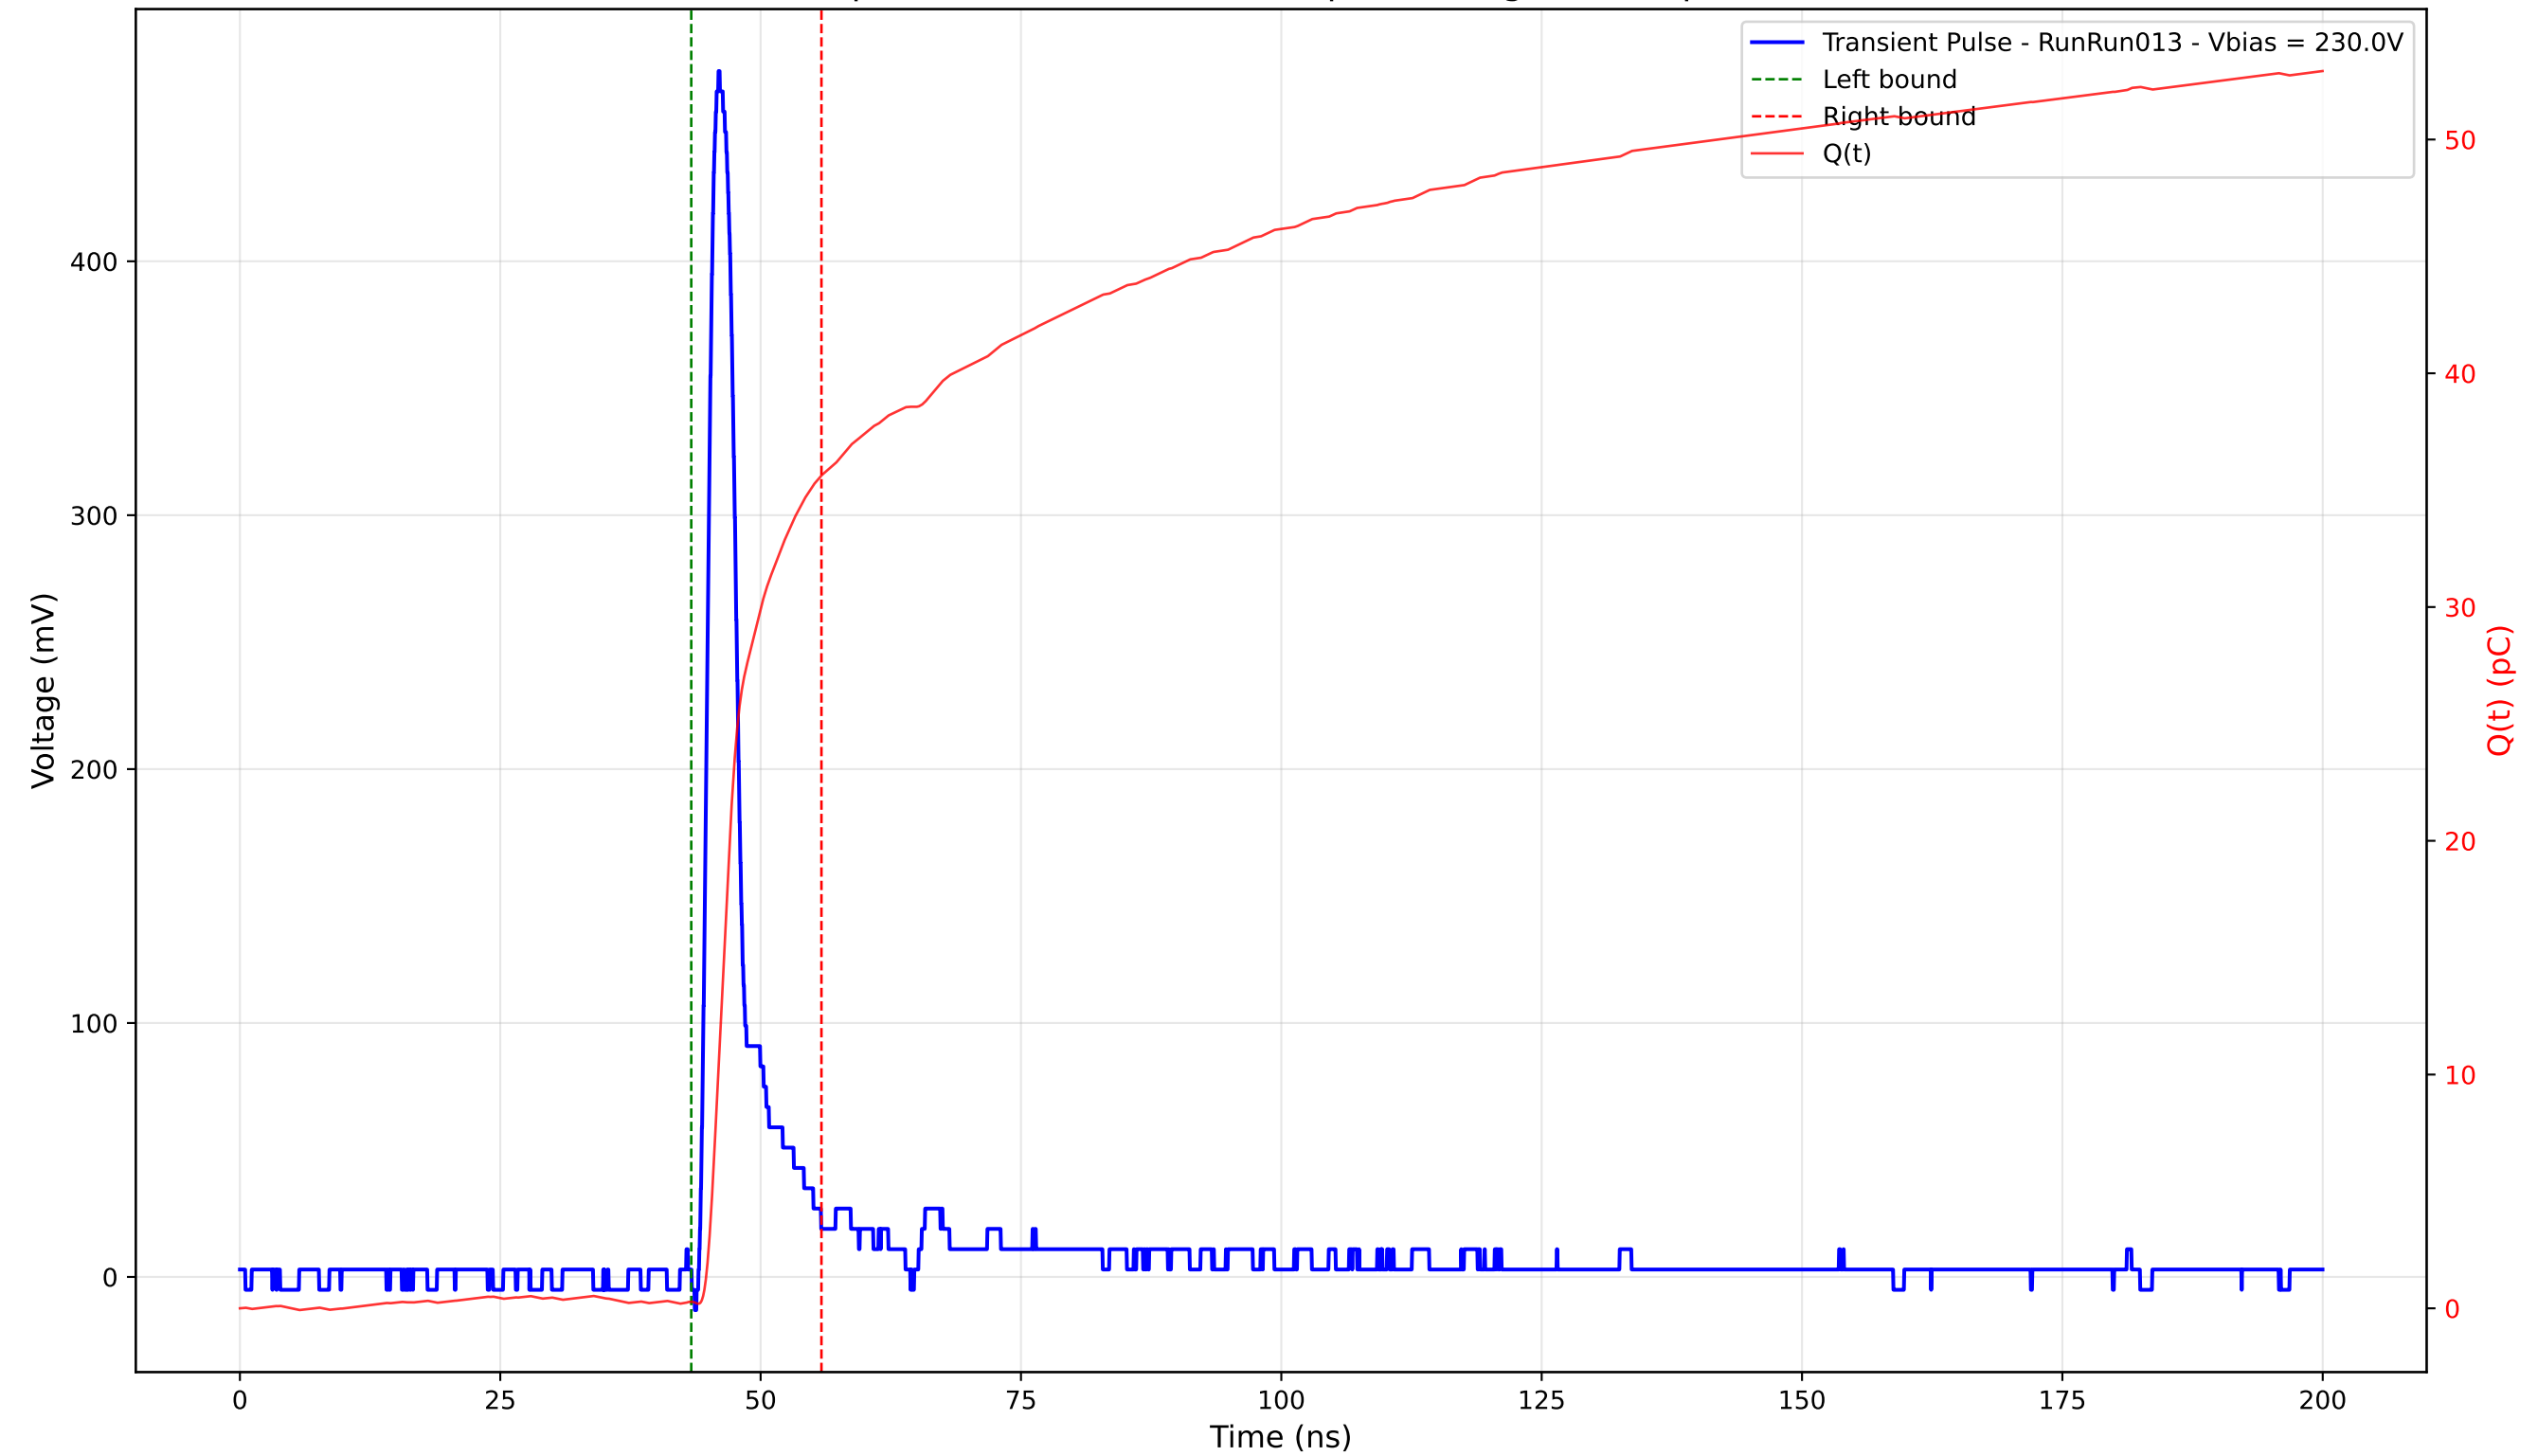


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 35.06 pC - Rise Time: 1.13 ns

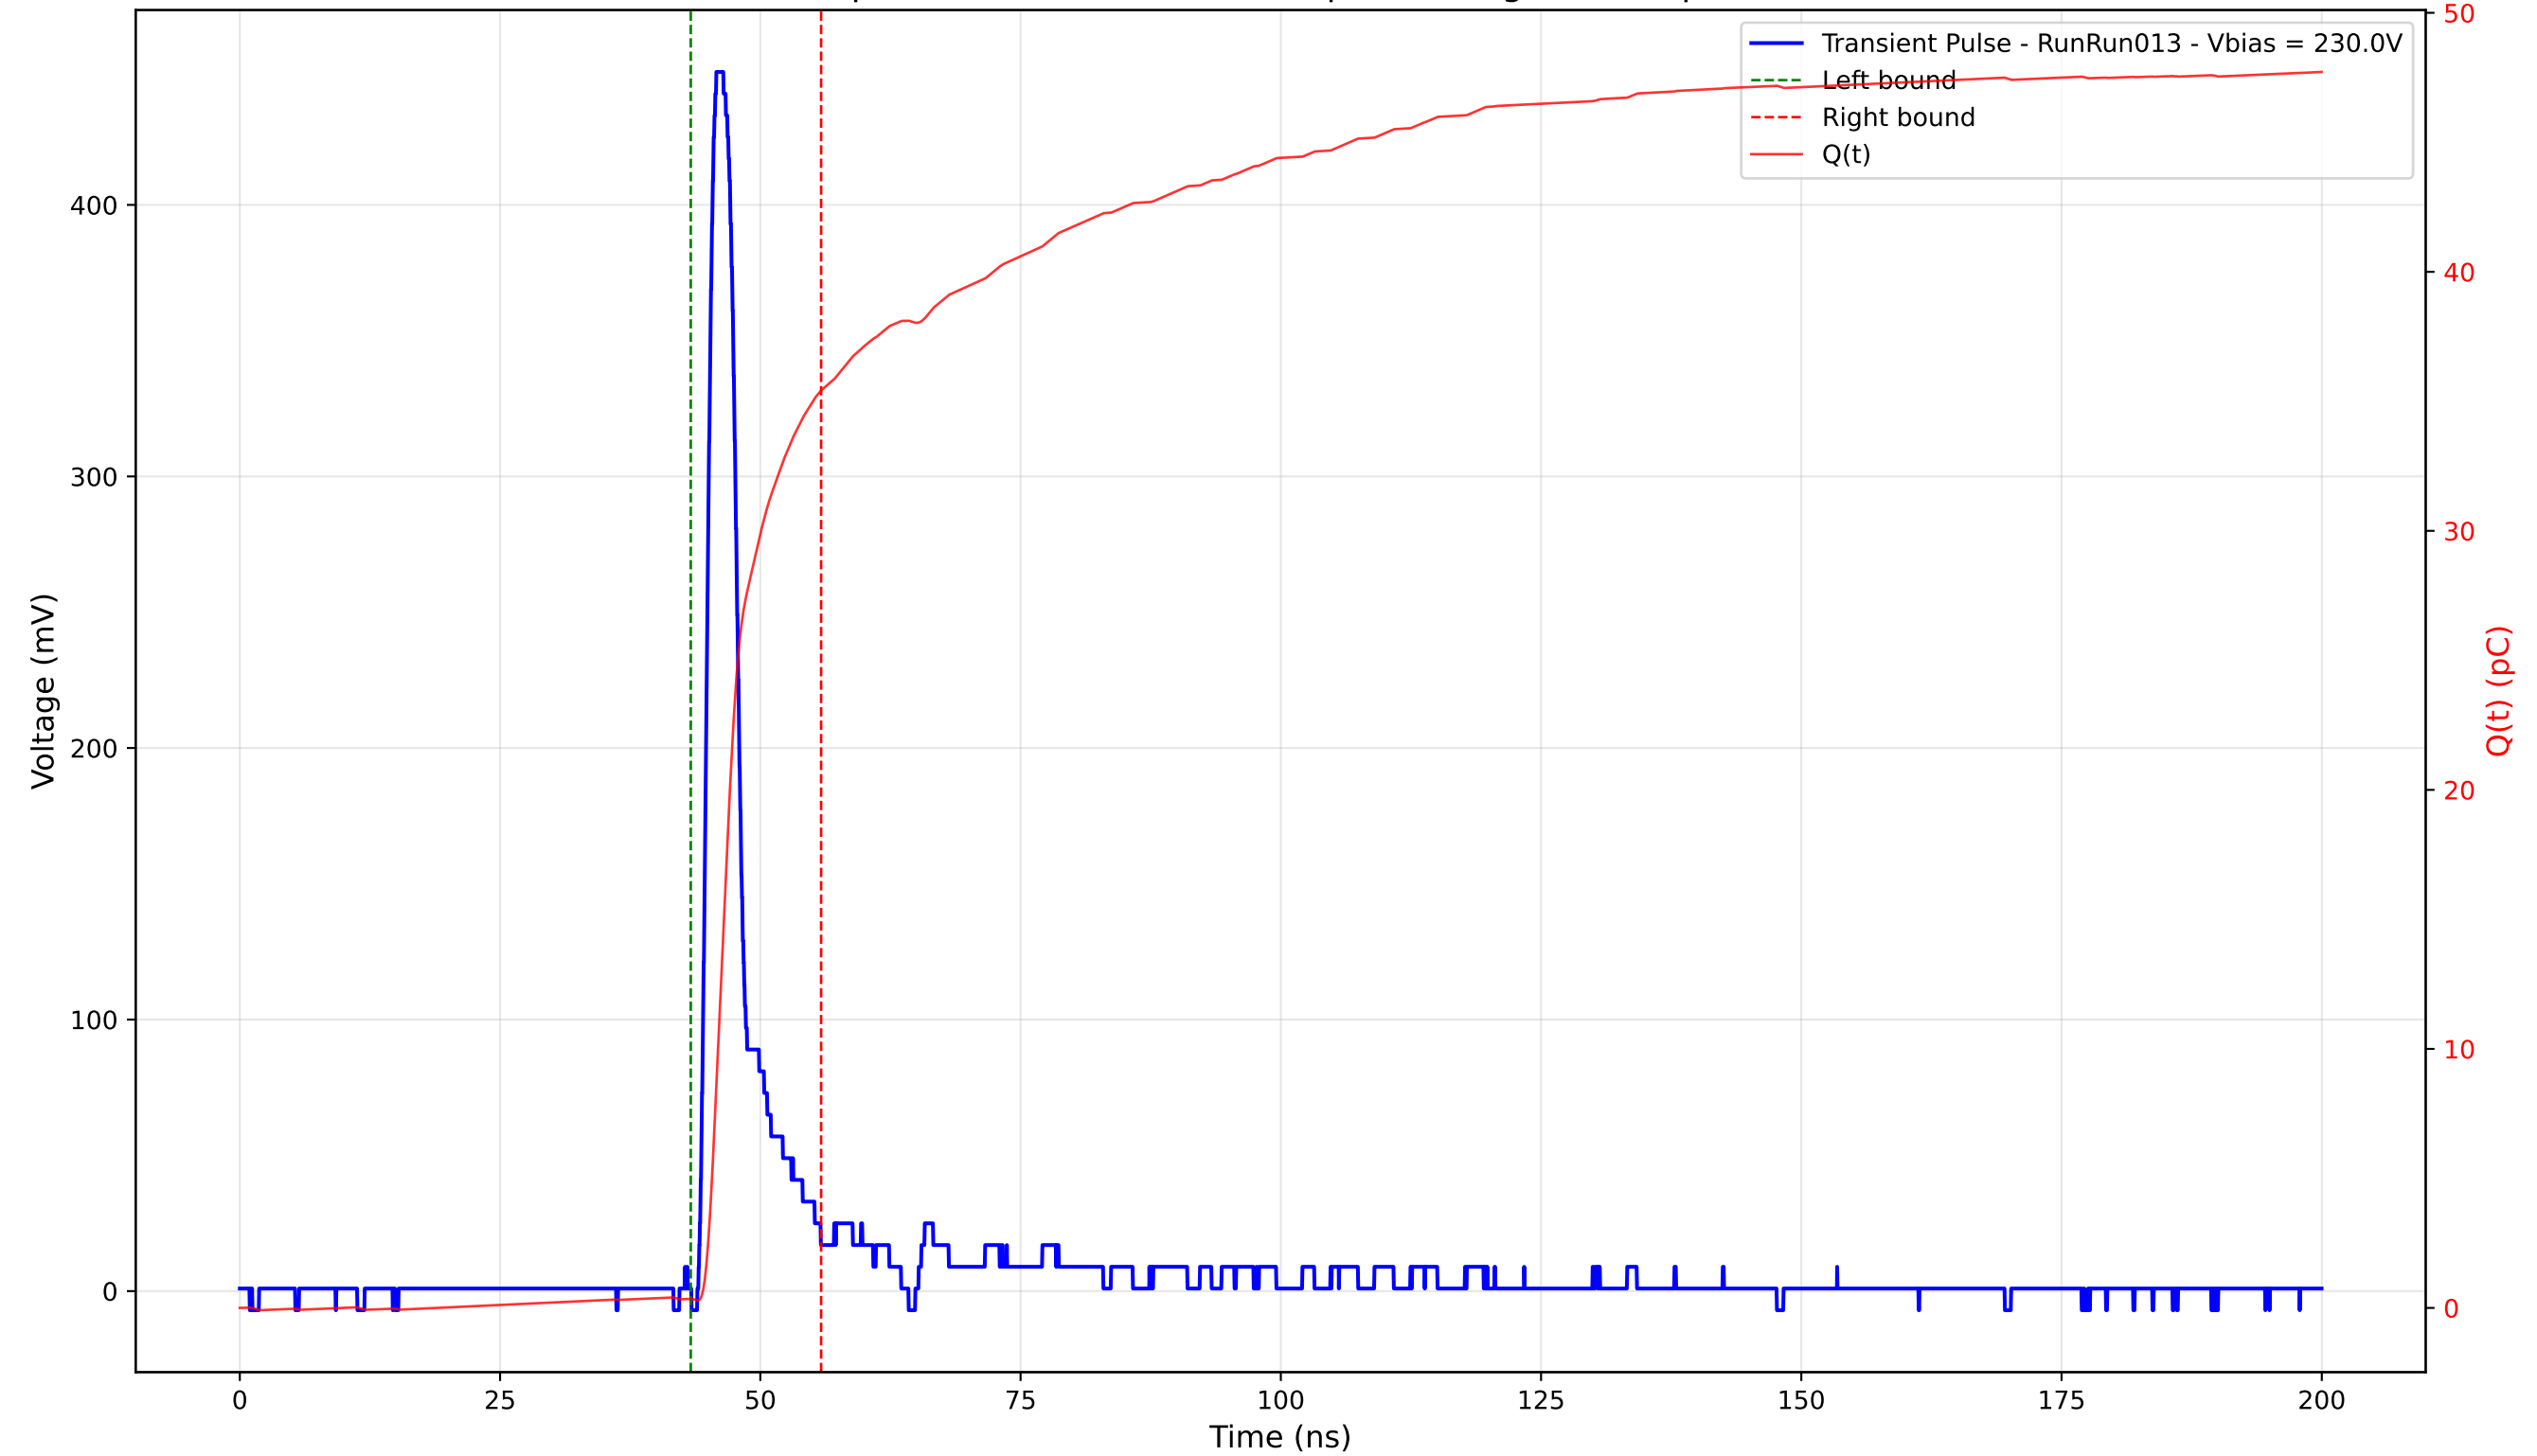


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 34.40 pC - Rise Time: 1.11 ns

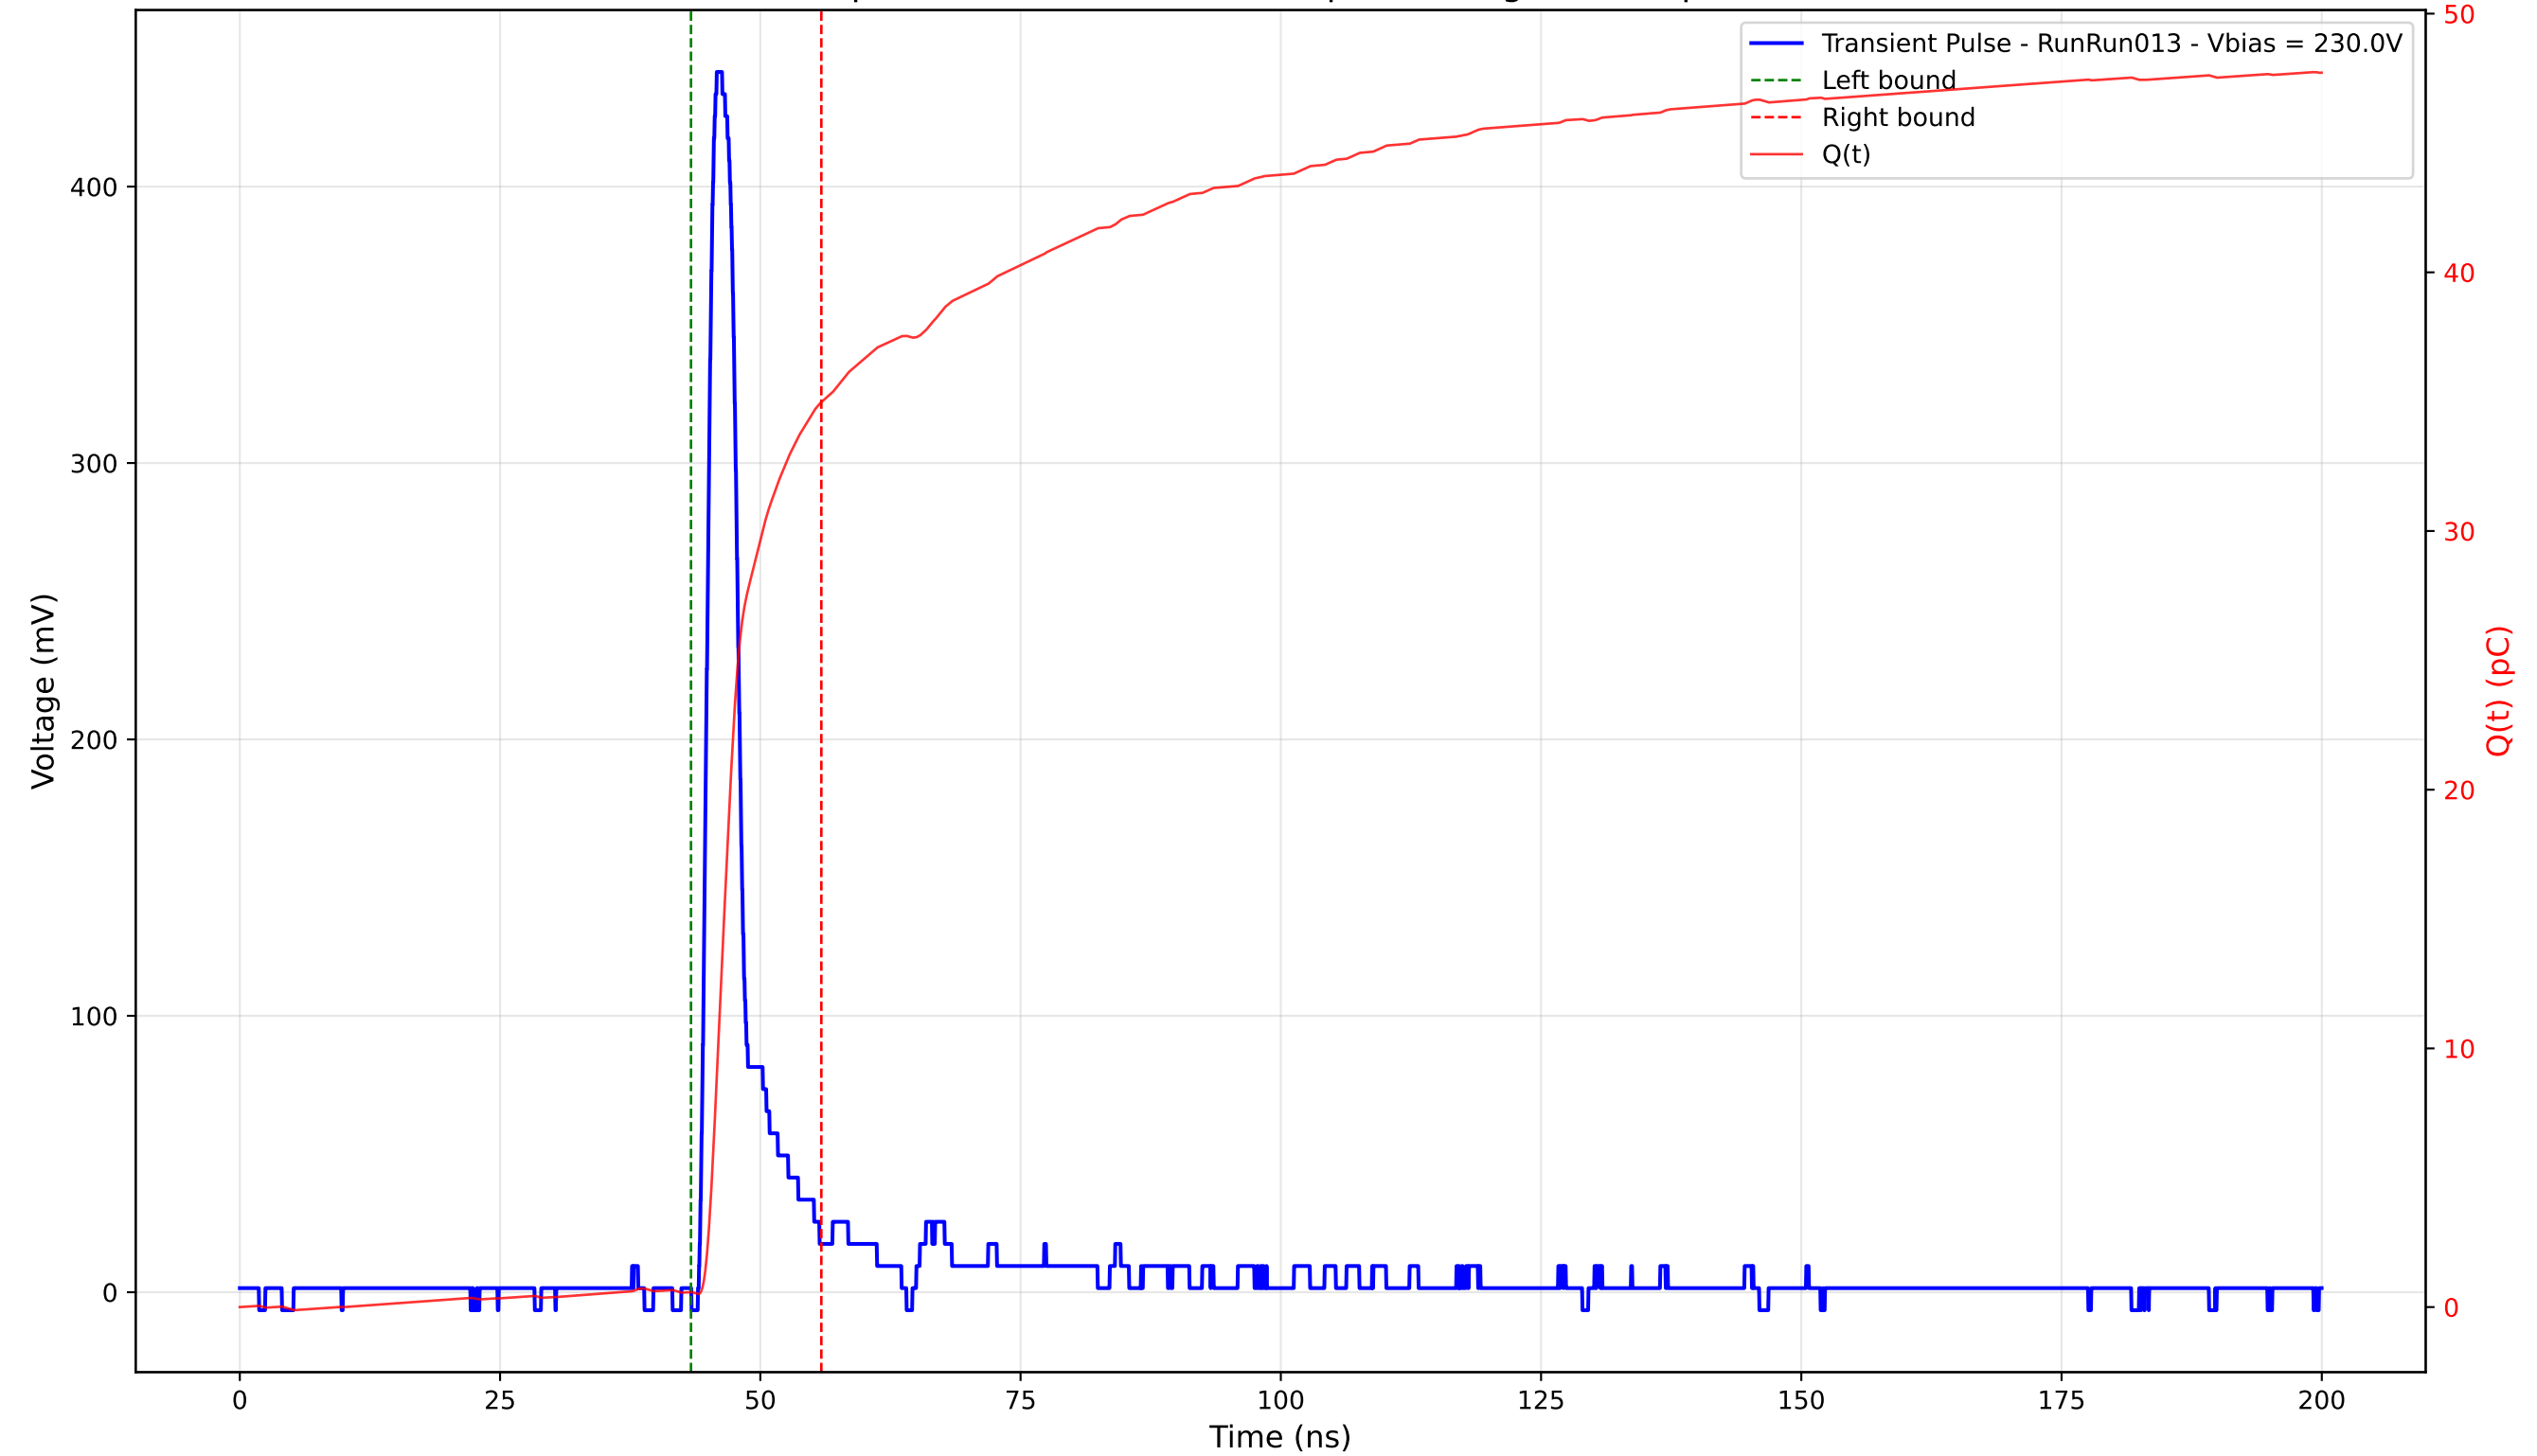


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 33.76 pC - Rise Time: 1.12 ns

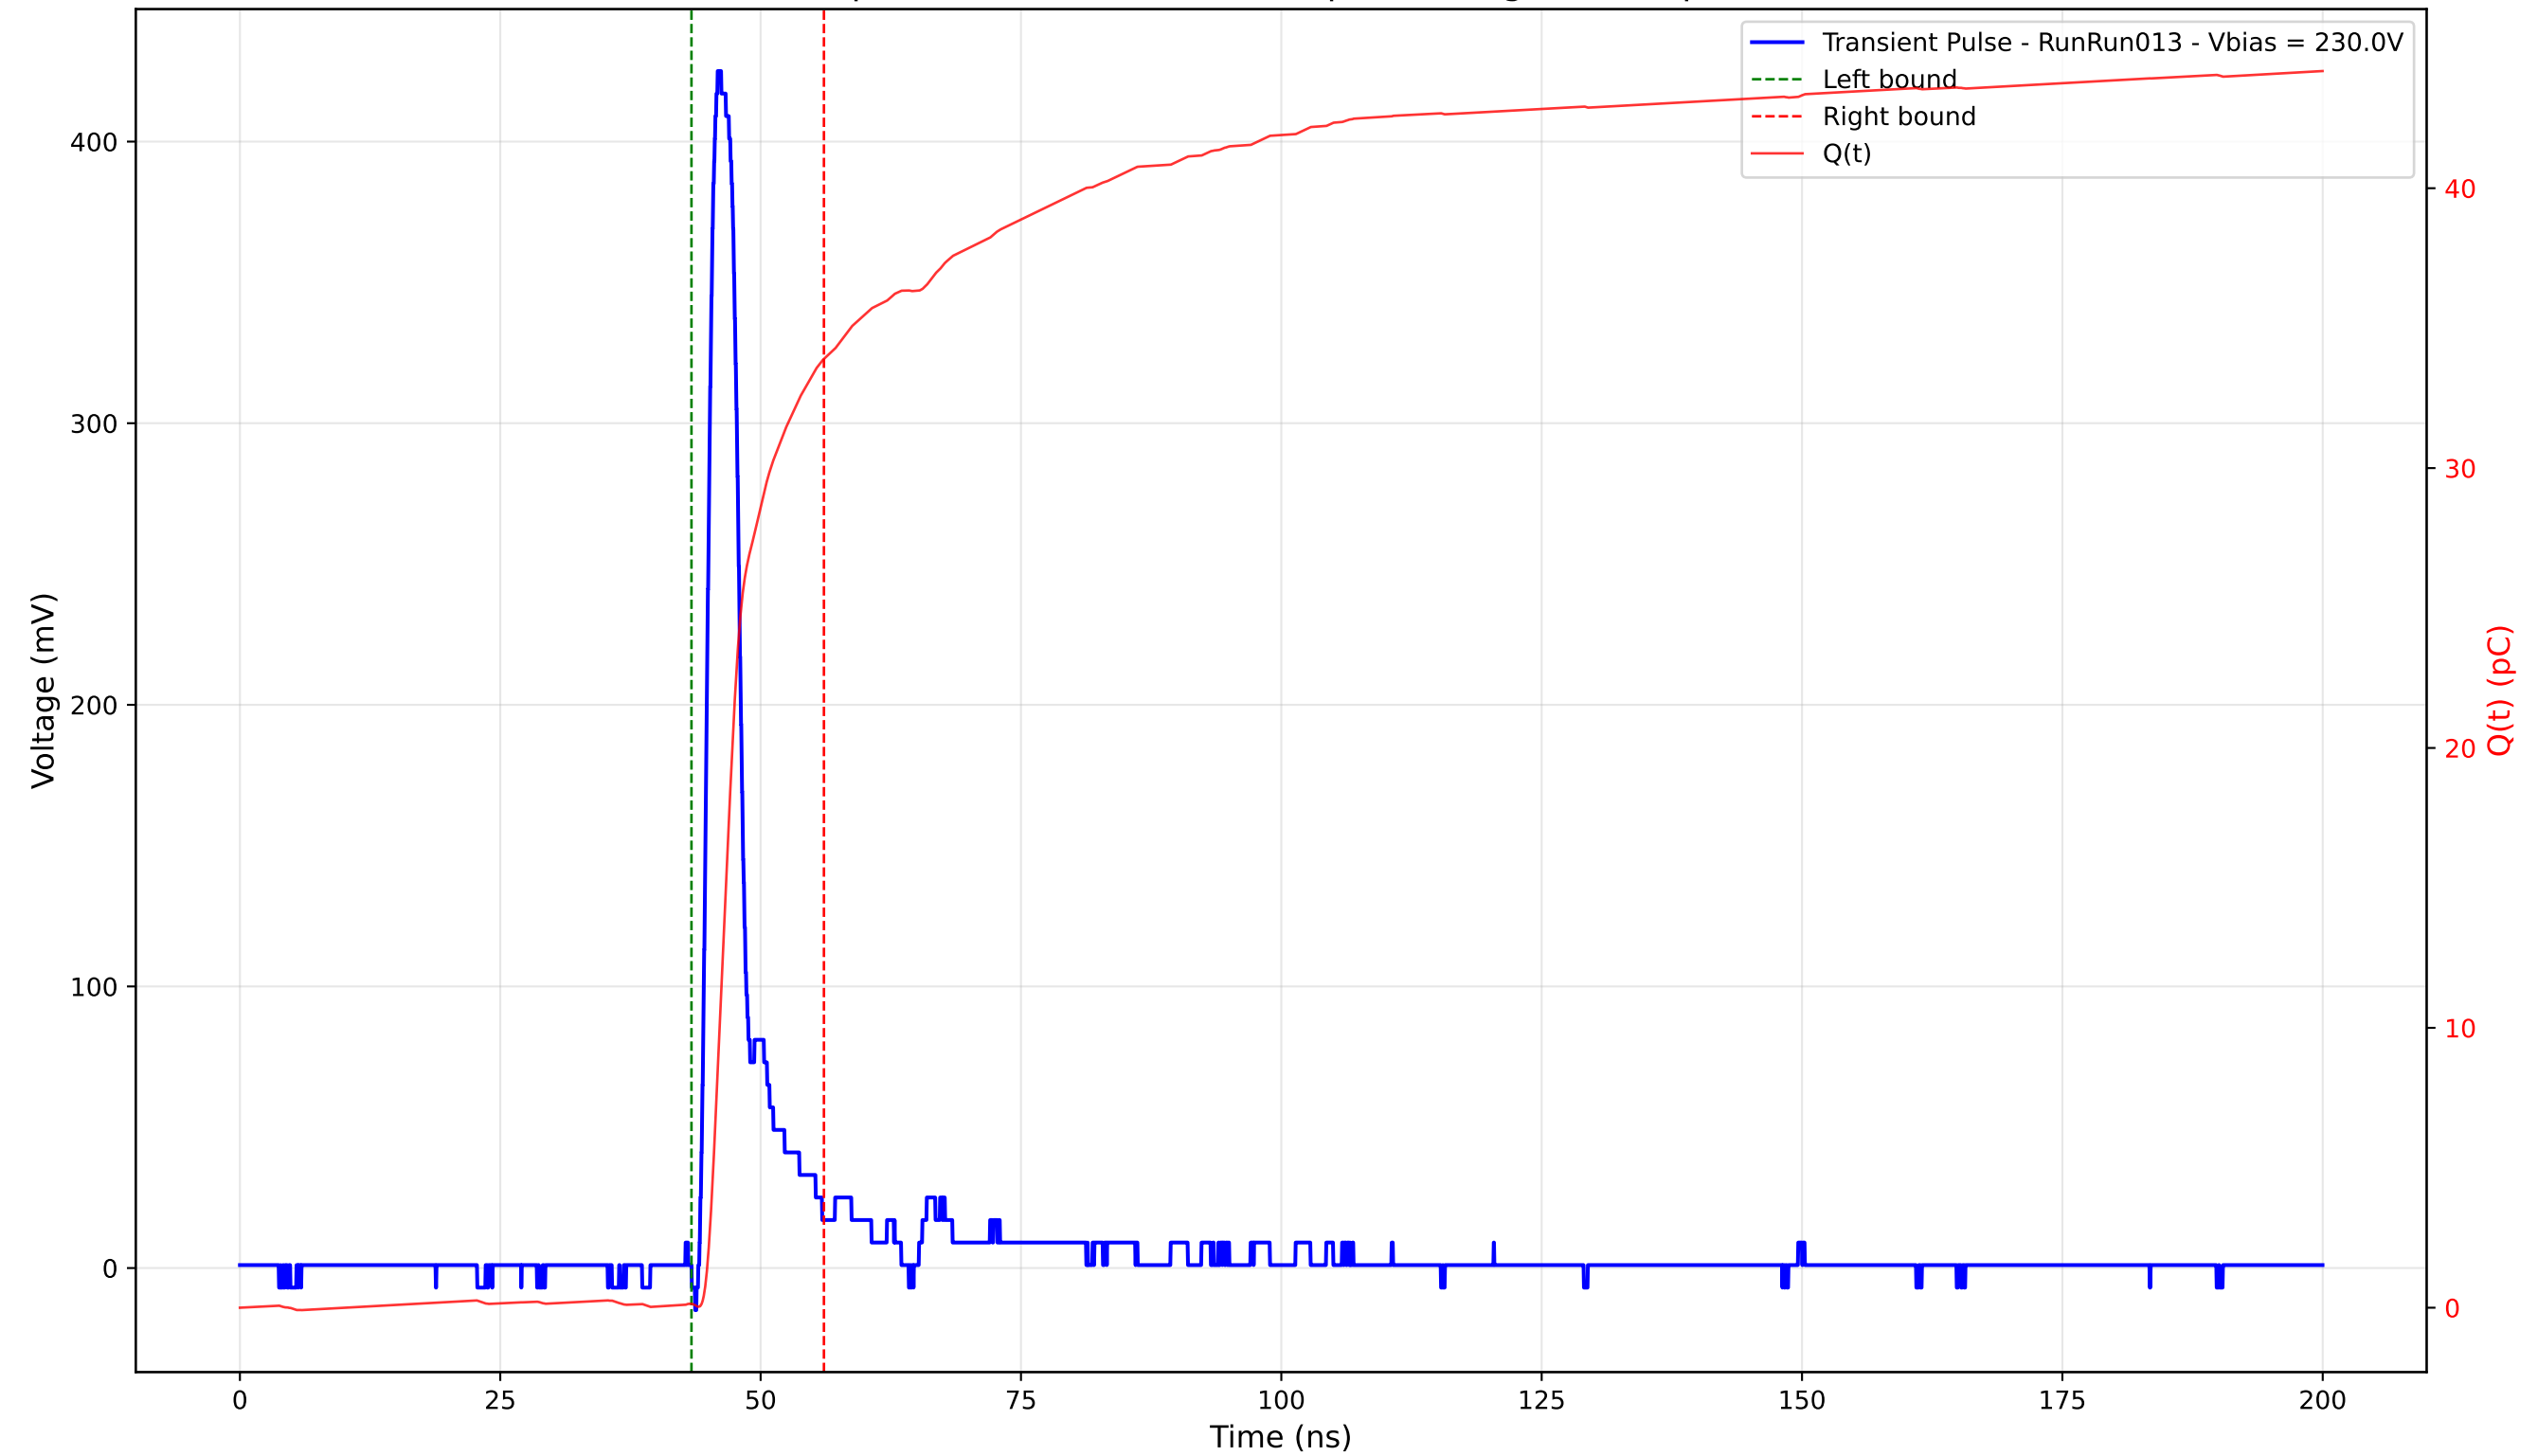


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 33.86 pC - Rise Time: 1.14 ns

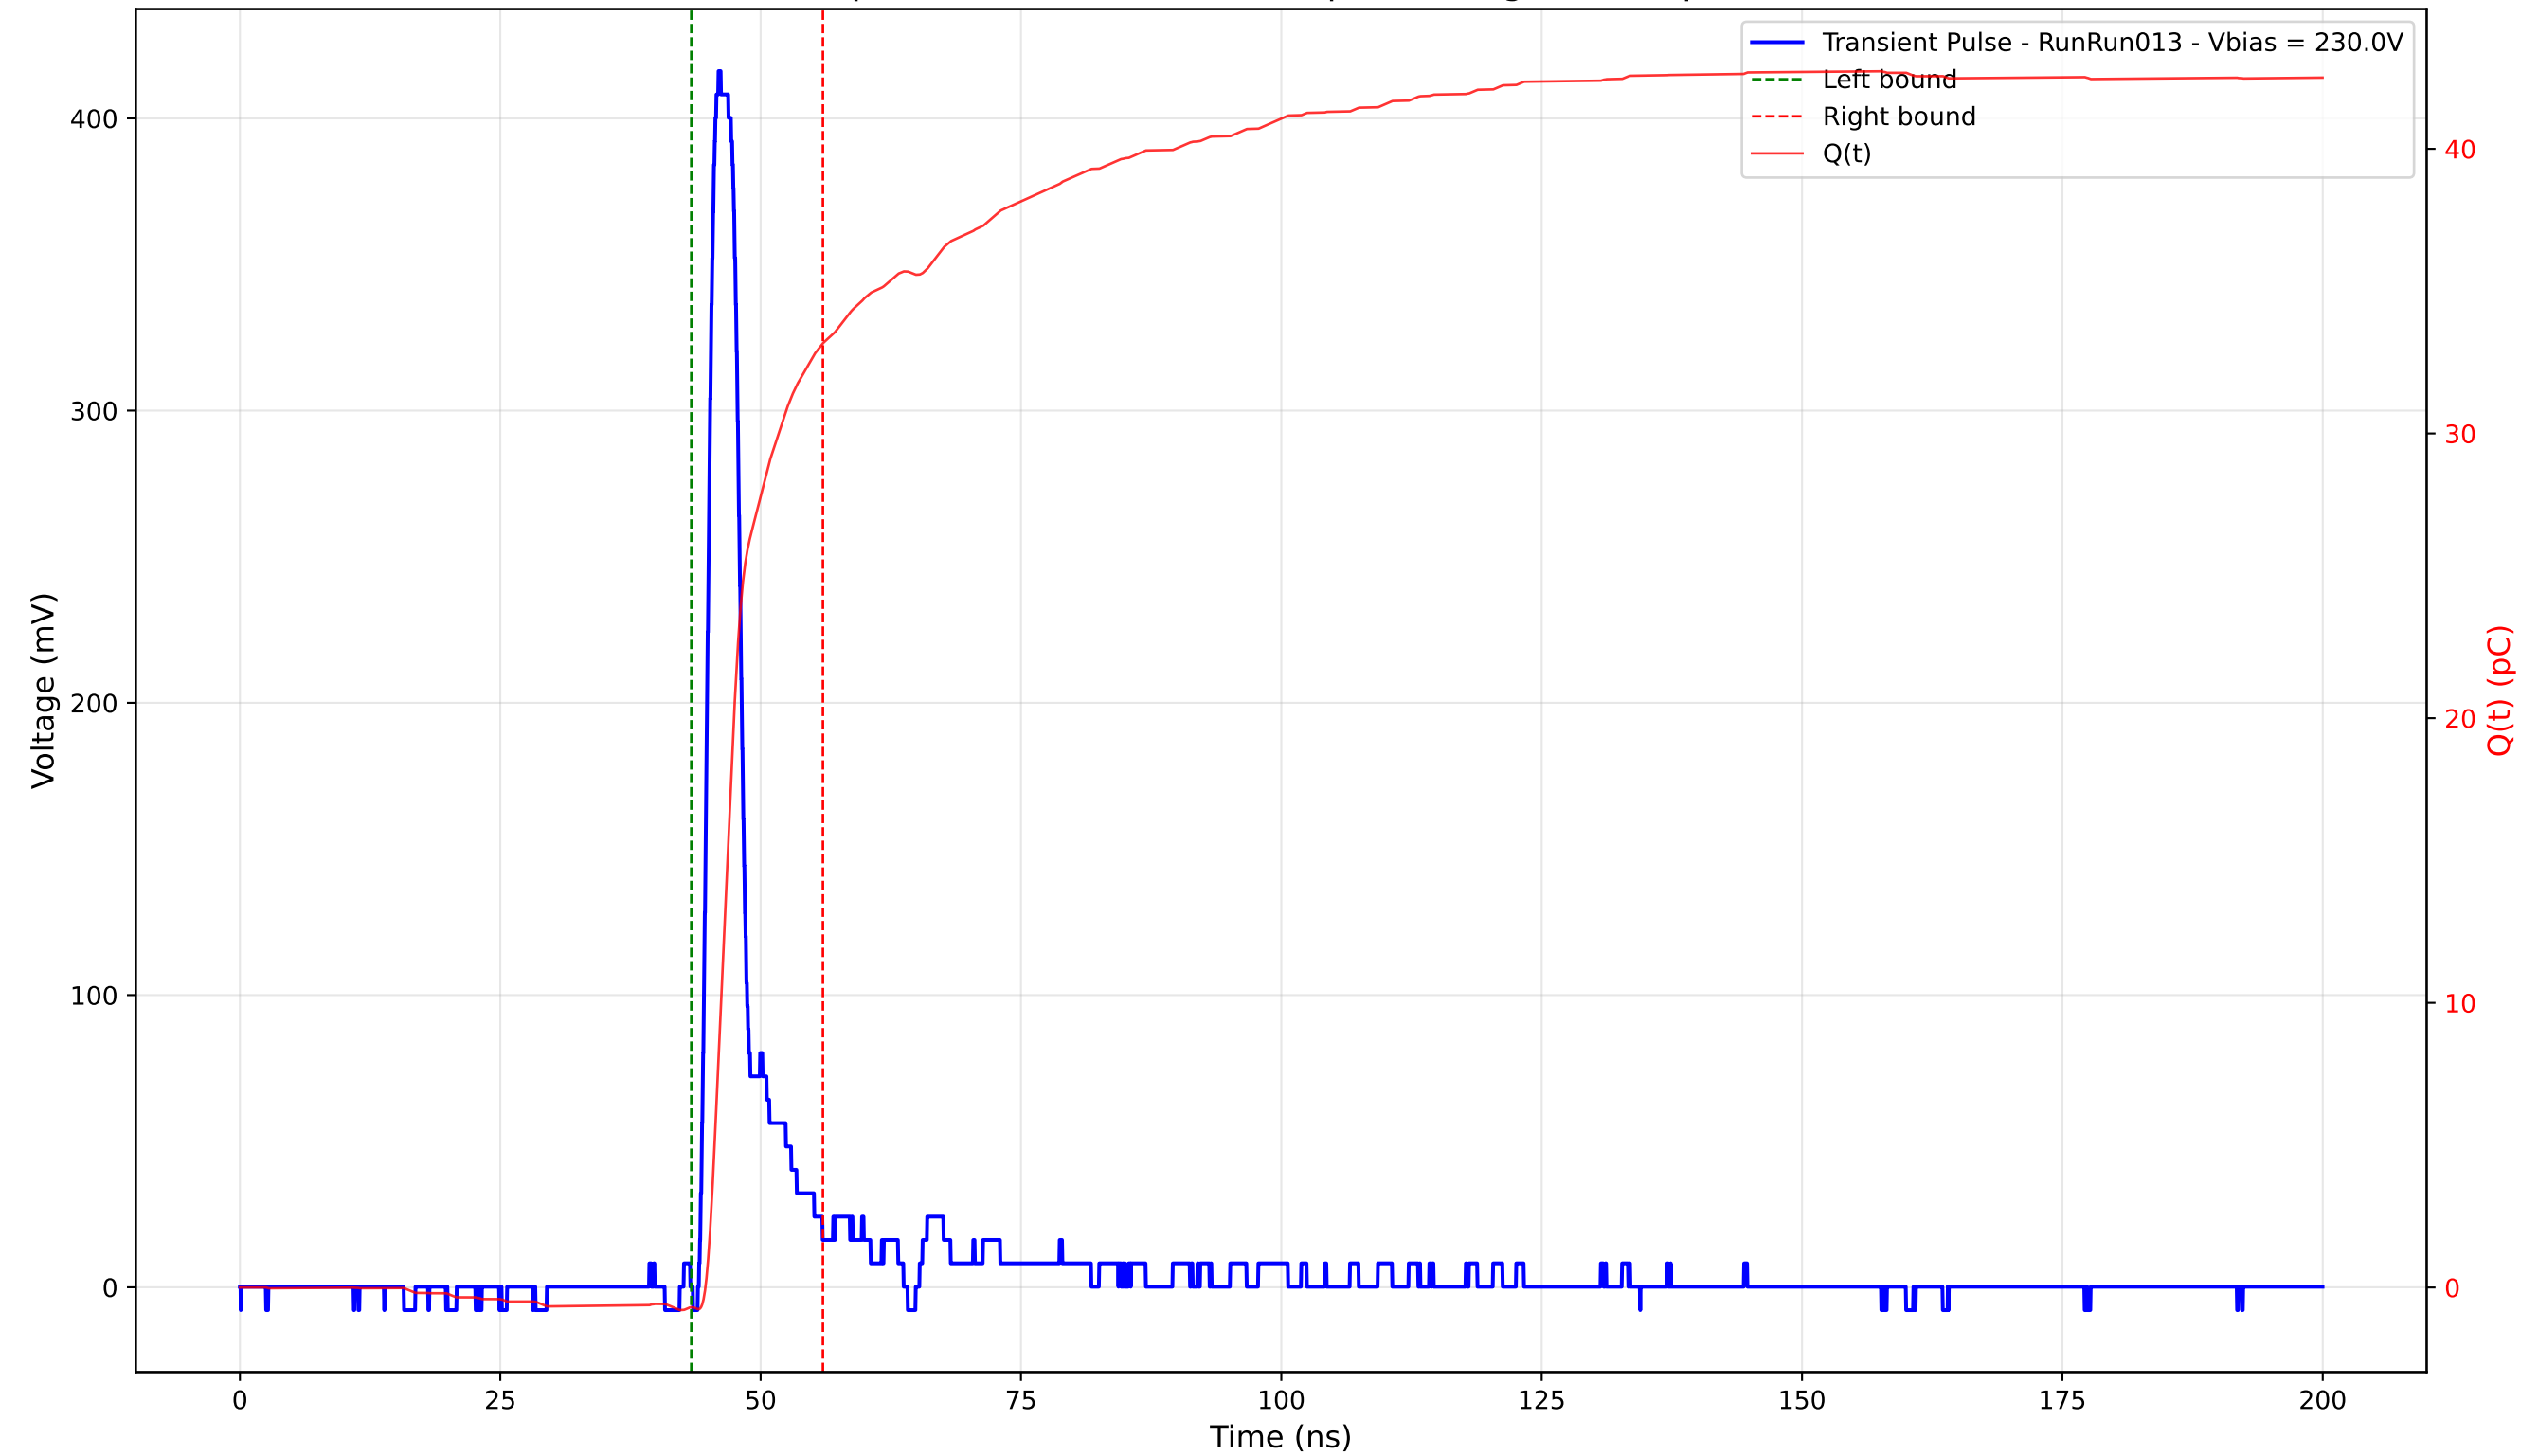


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 34.68 pC - Rise Time: 1.14 ns

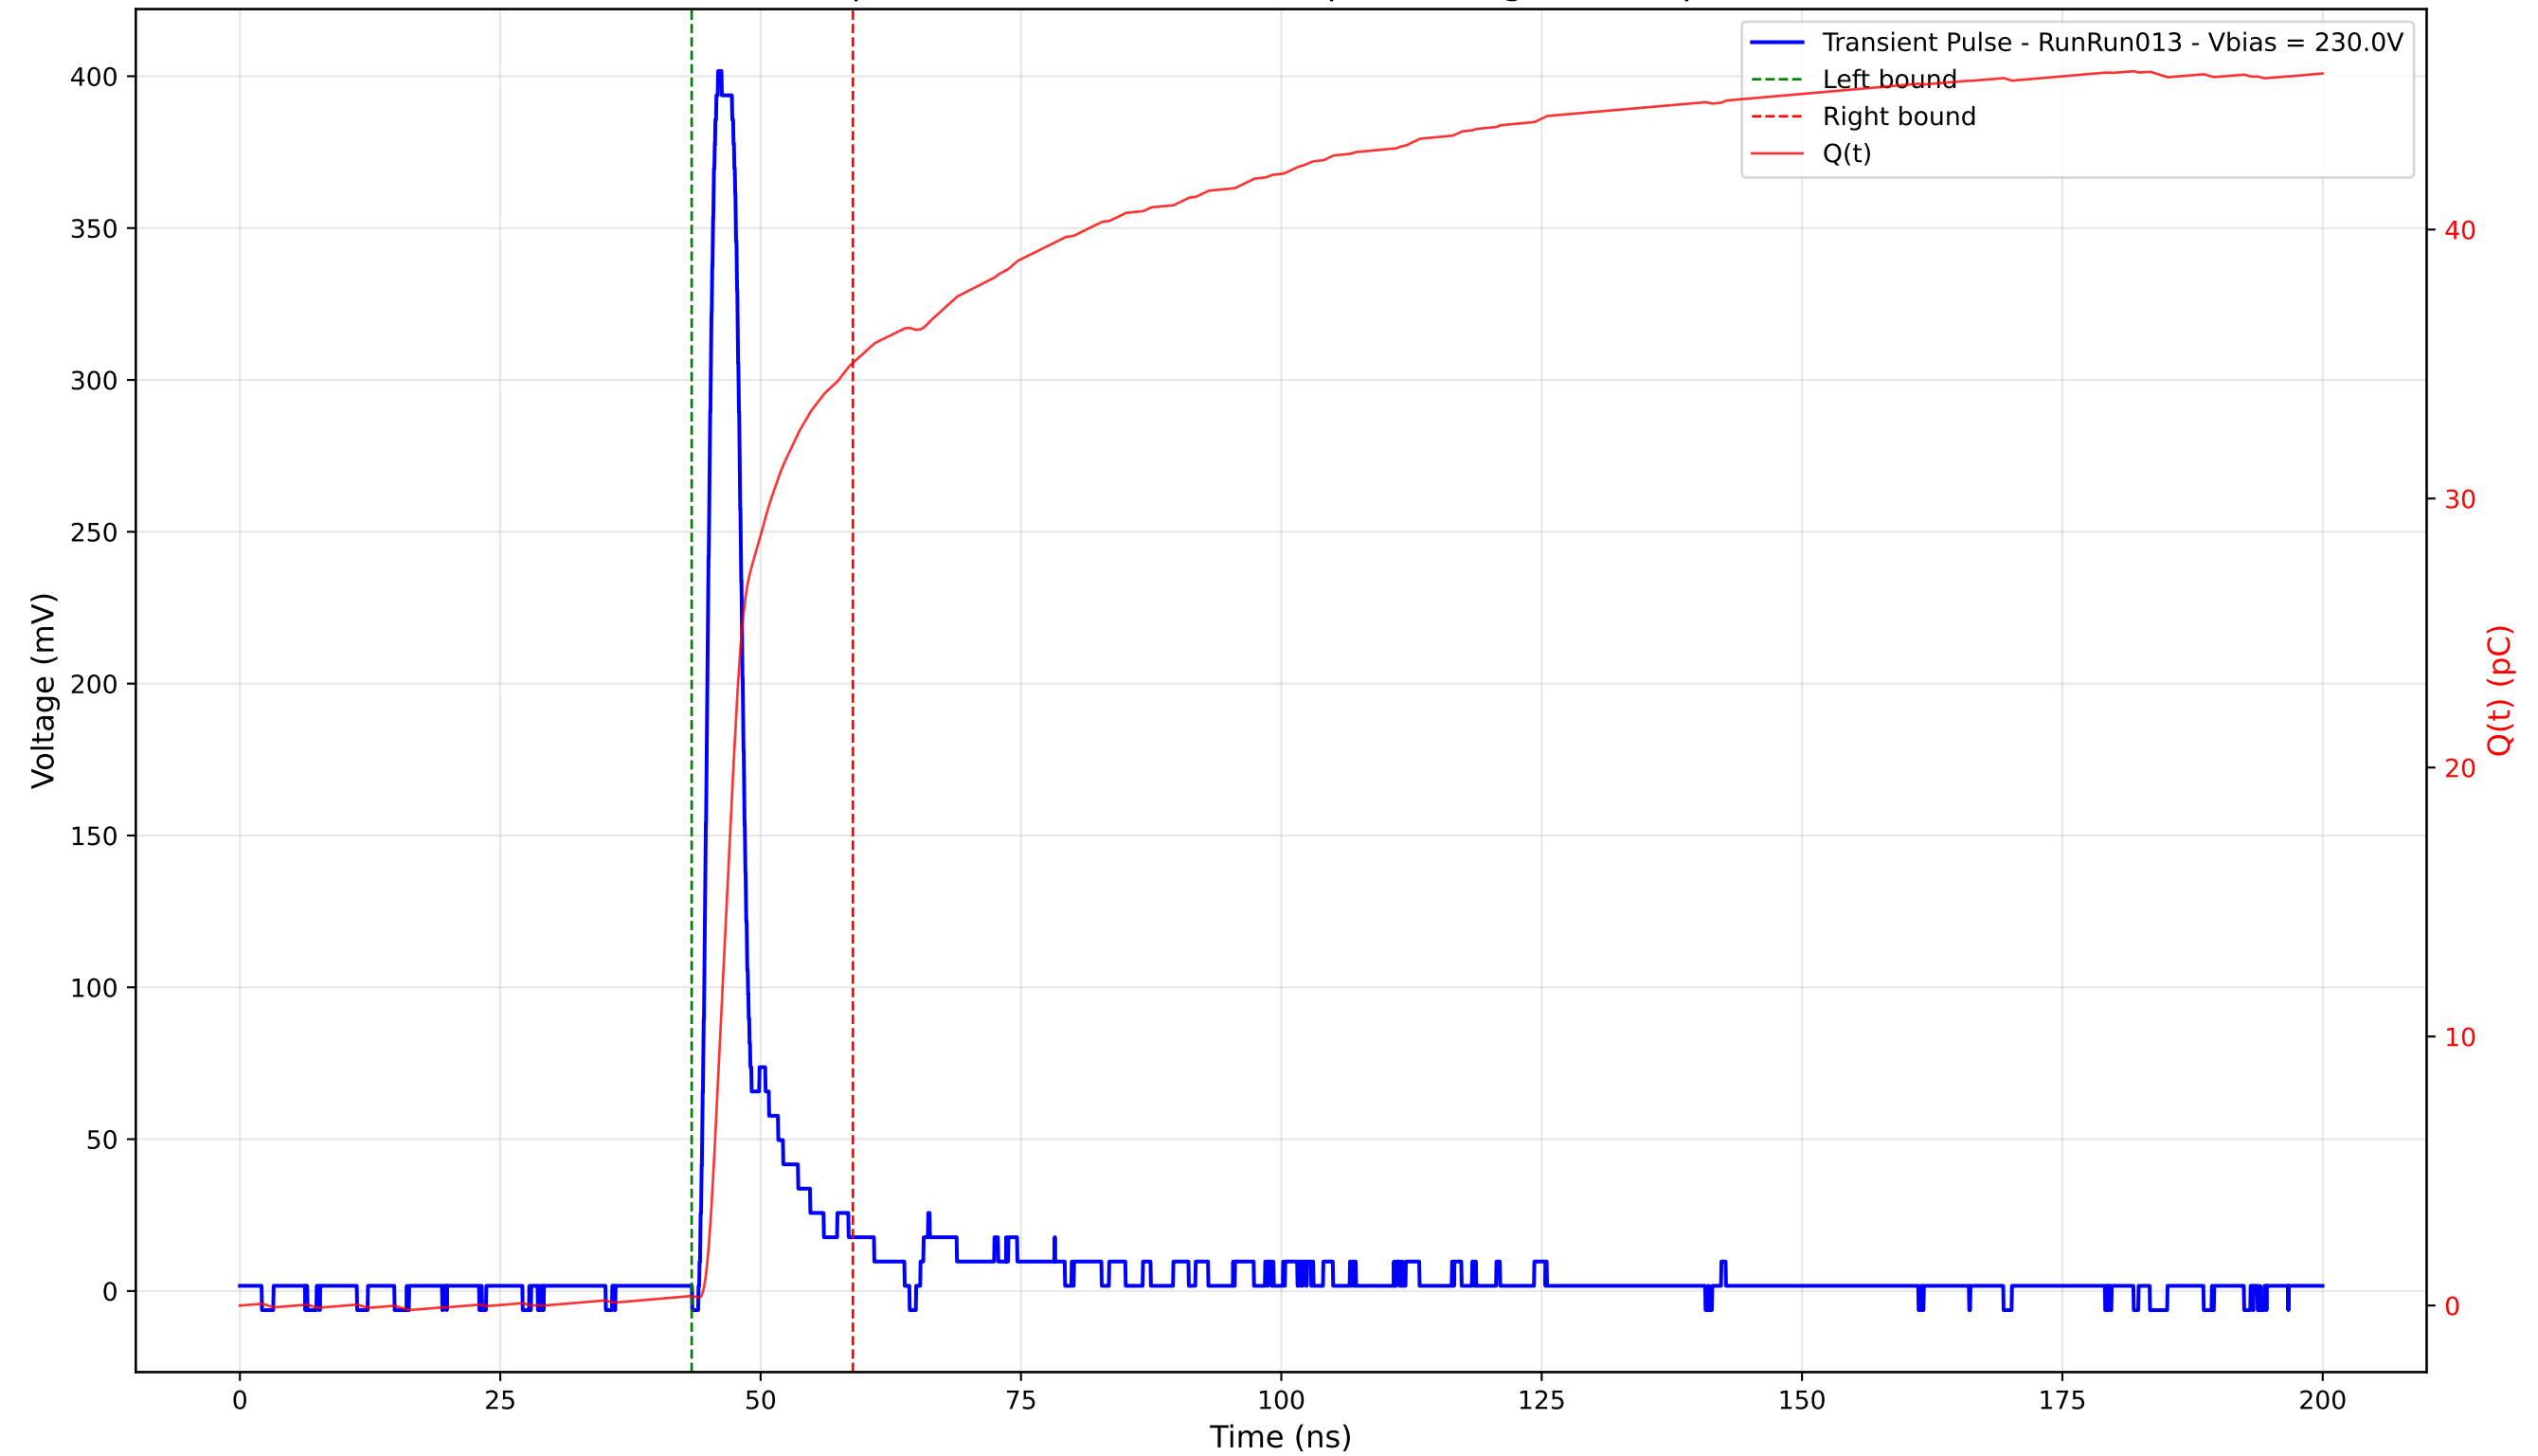


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 33.40 pC - Rise Time: 1.17 ns

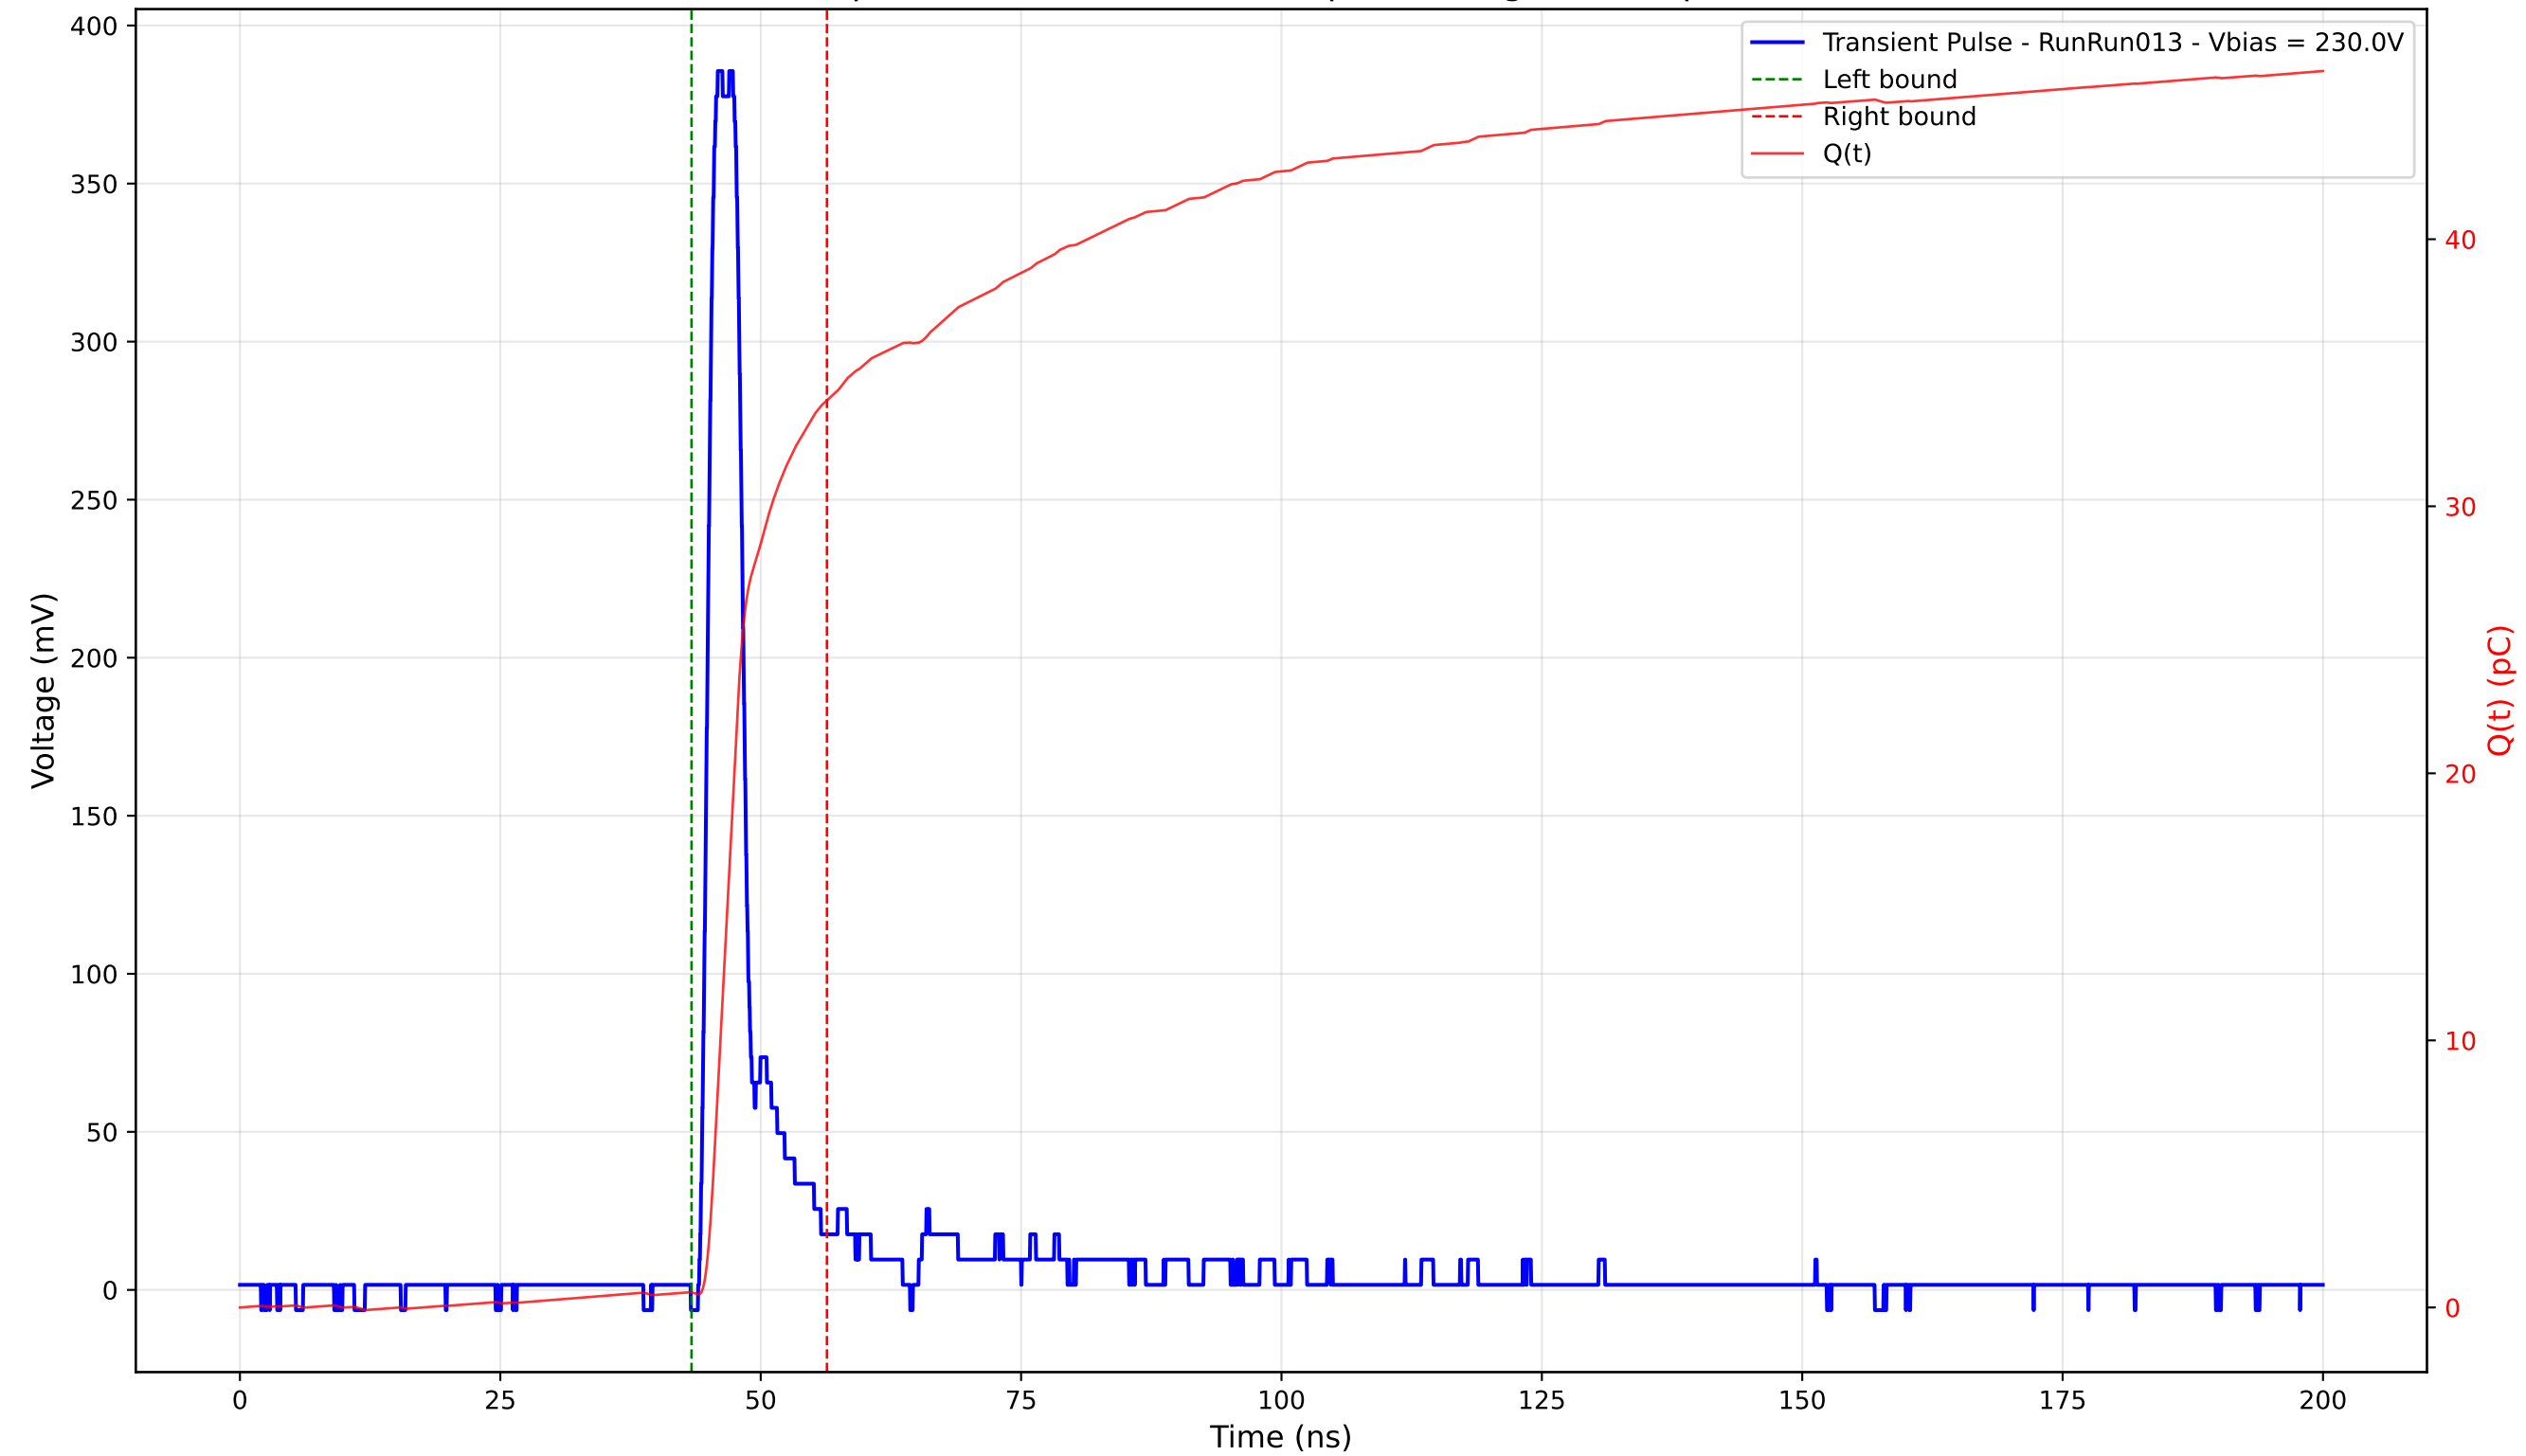


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 32.70 pC - Rise Time: 1.19 ns

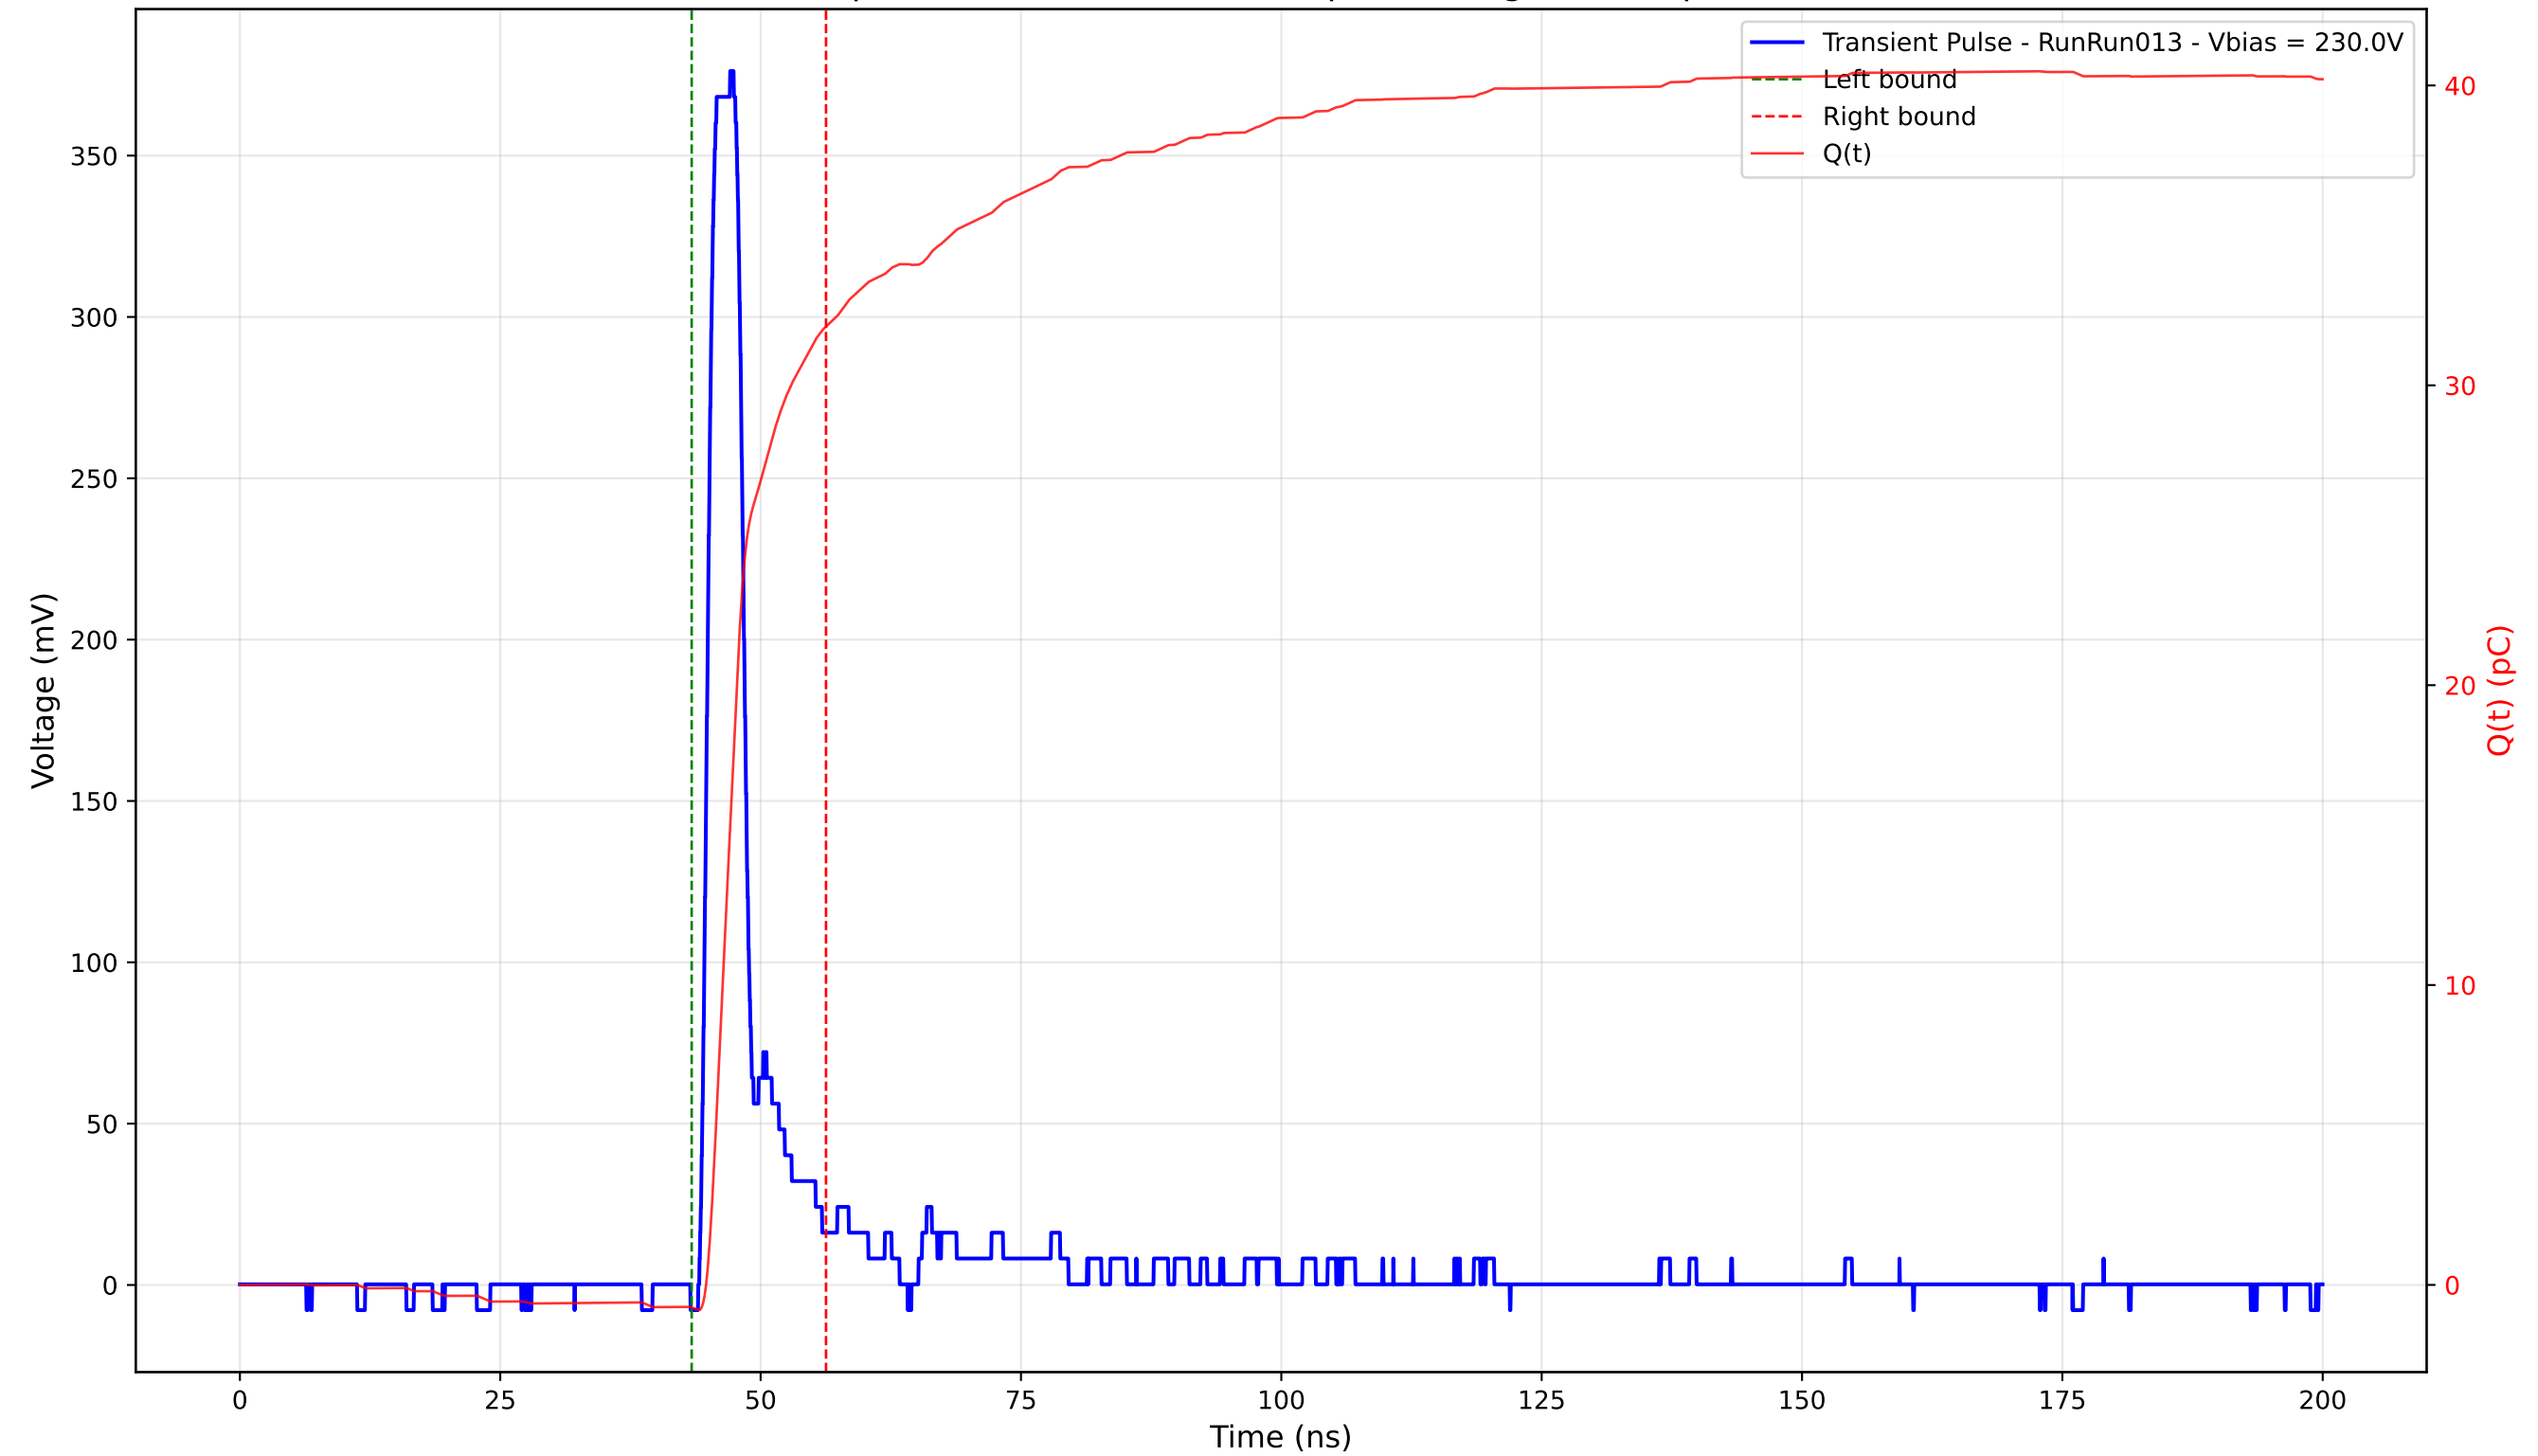


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 34.06 pC - Rise Time: 1.21 ns

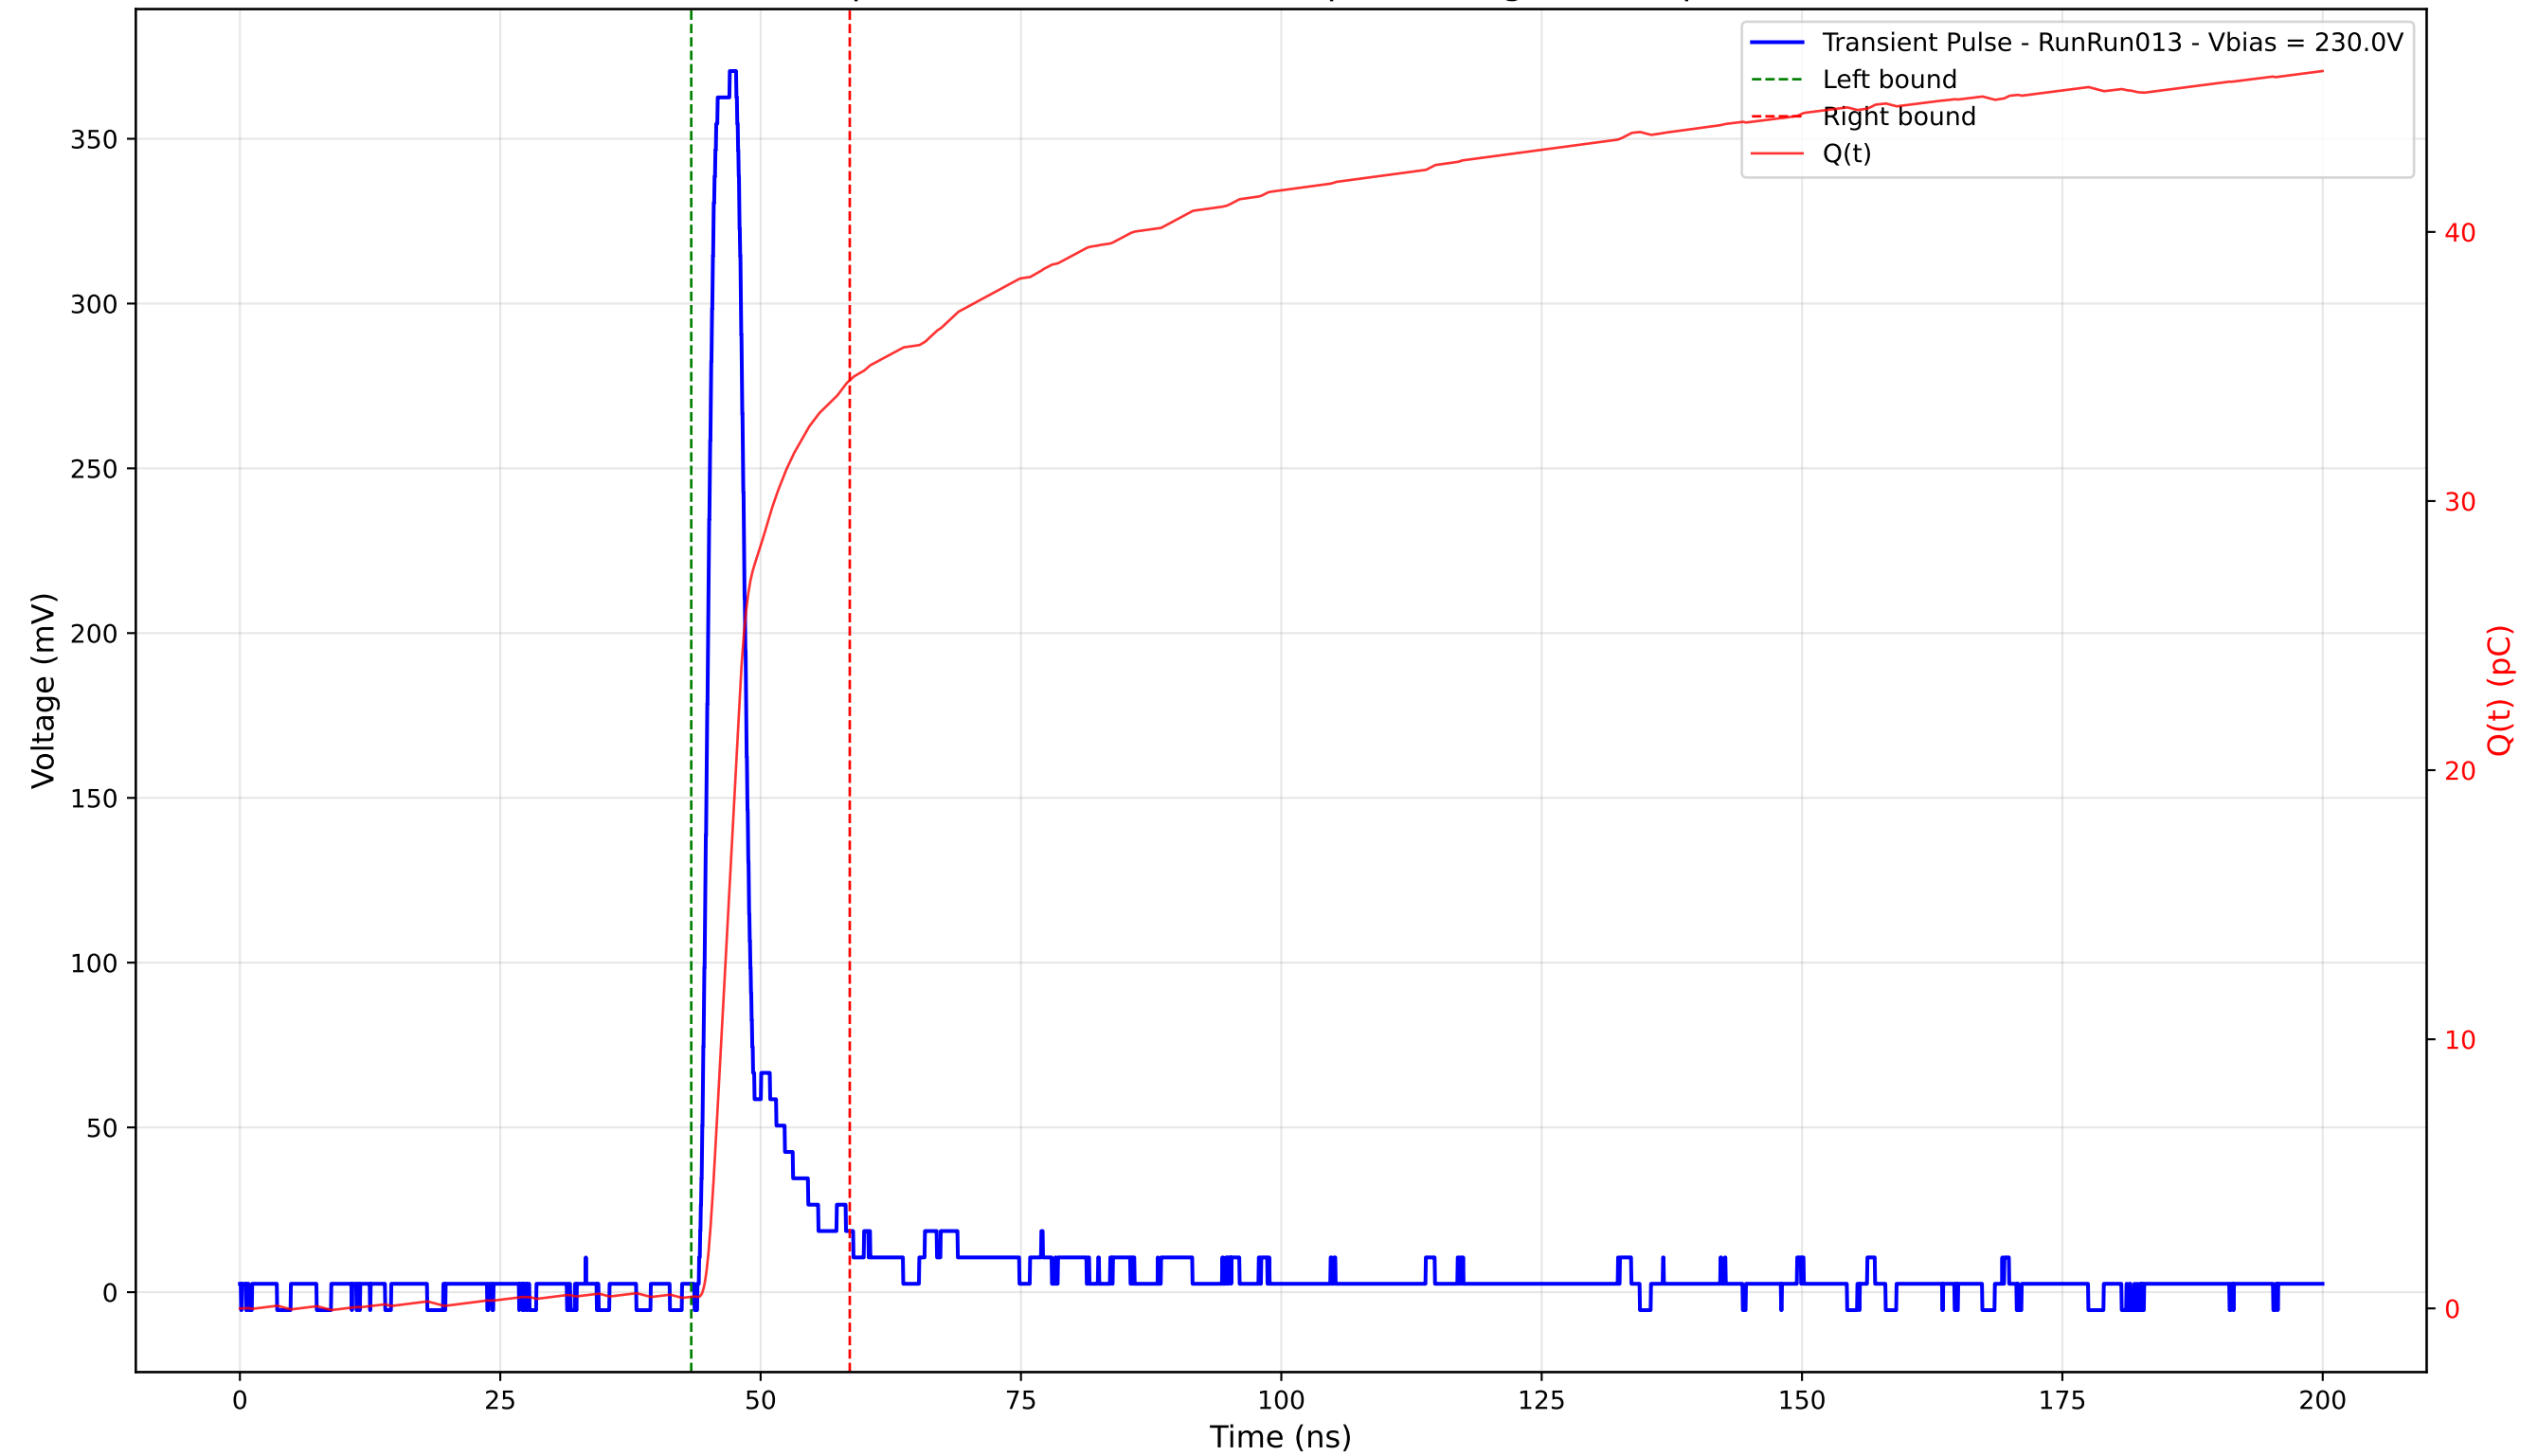


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 33.41 pC - Rise Time: 1.31 ns

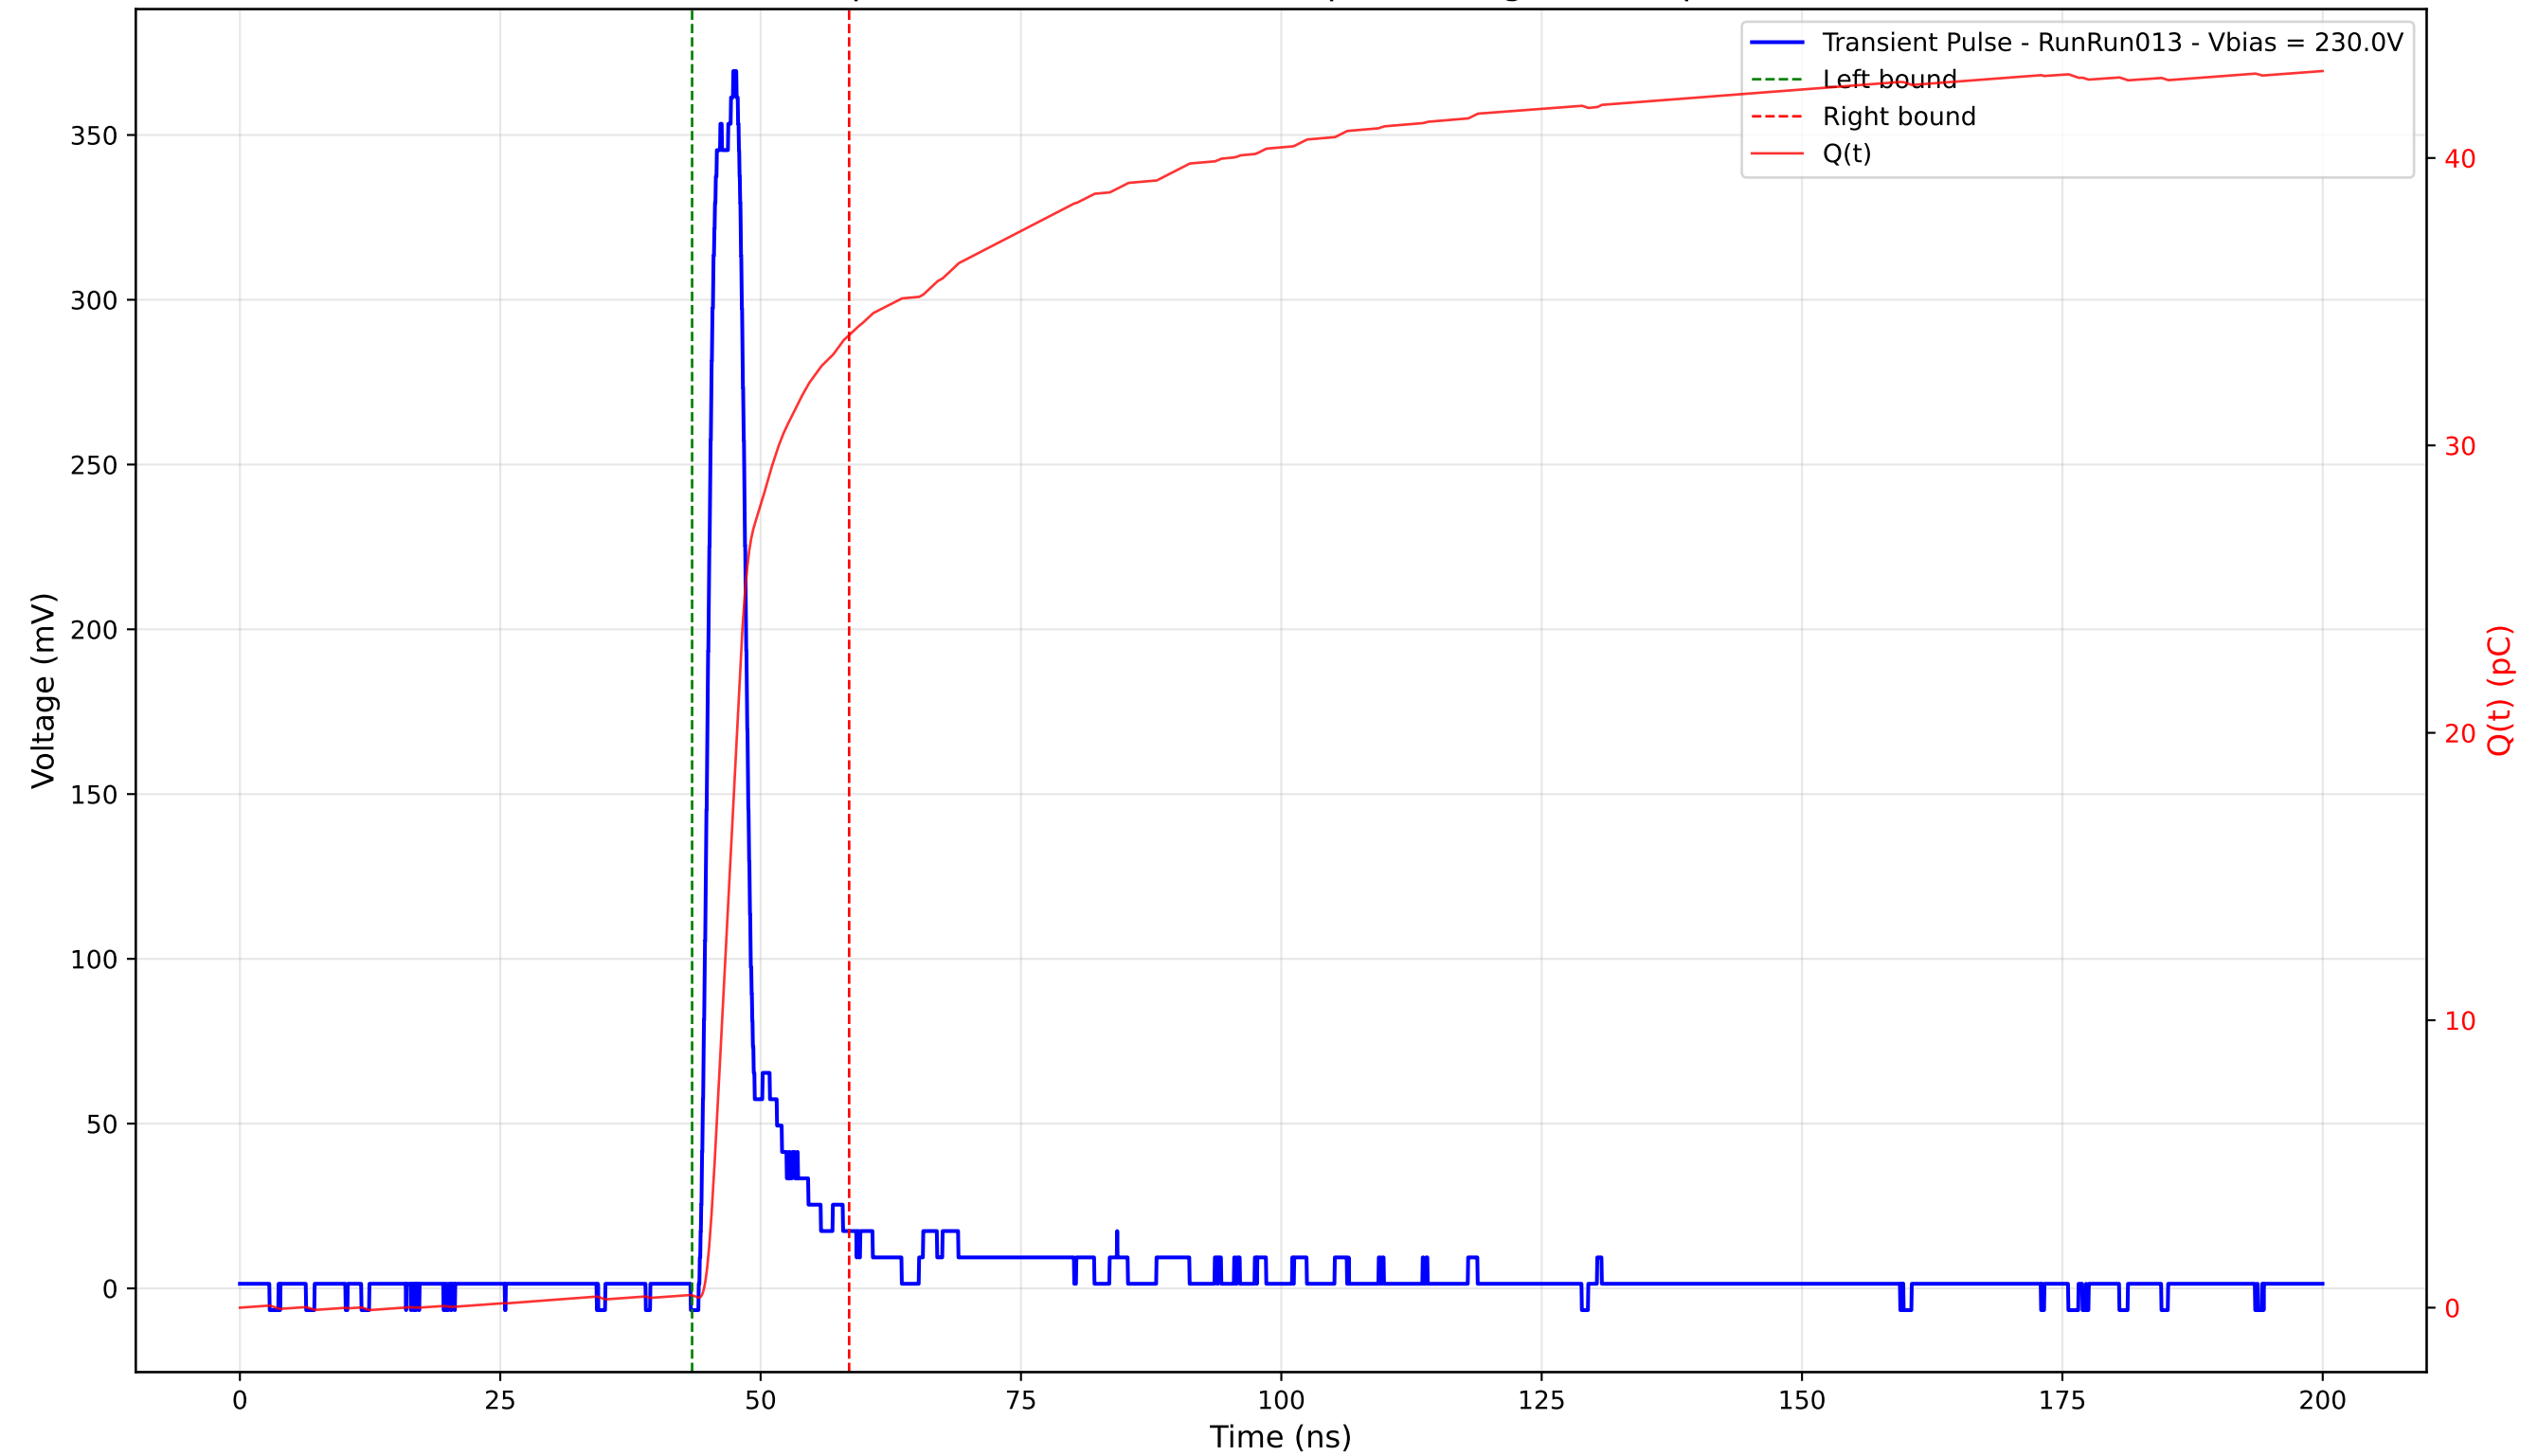


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 32.72 pC - Rise Time: 1.45 ns

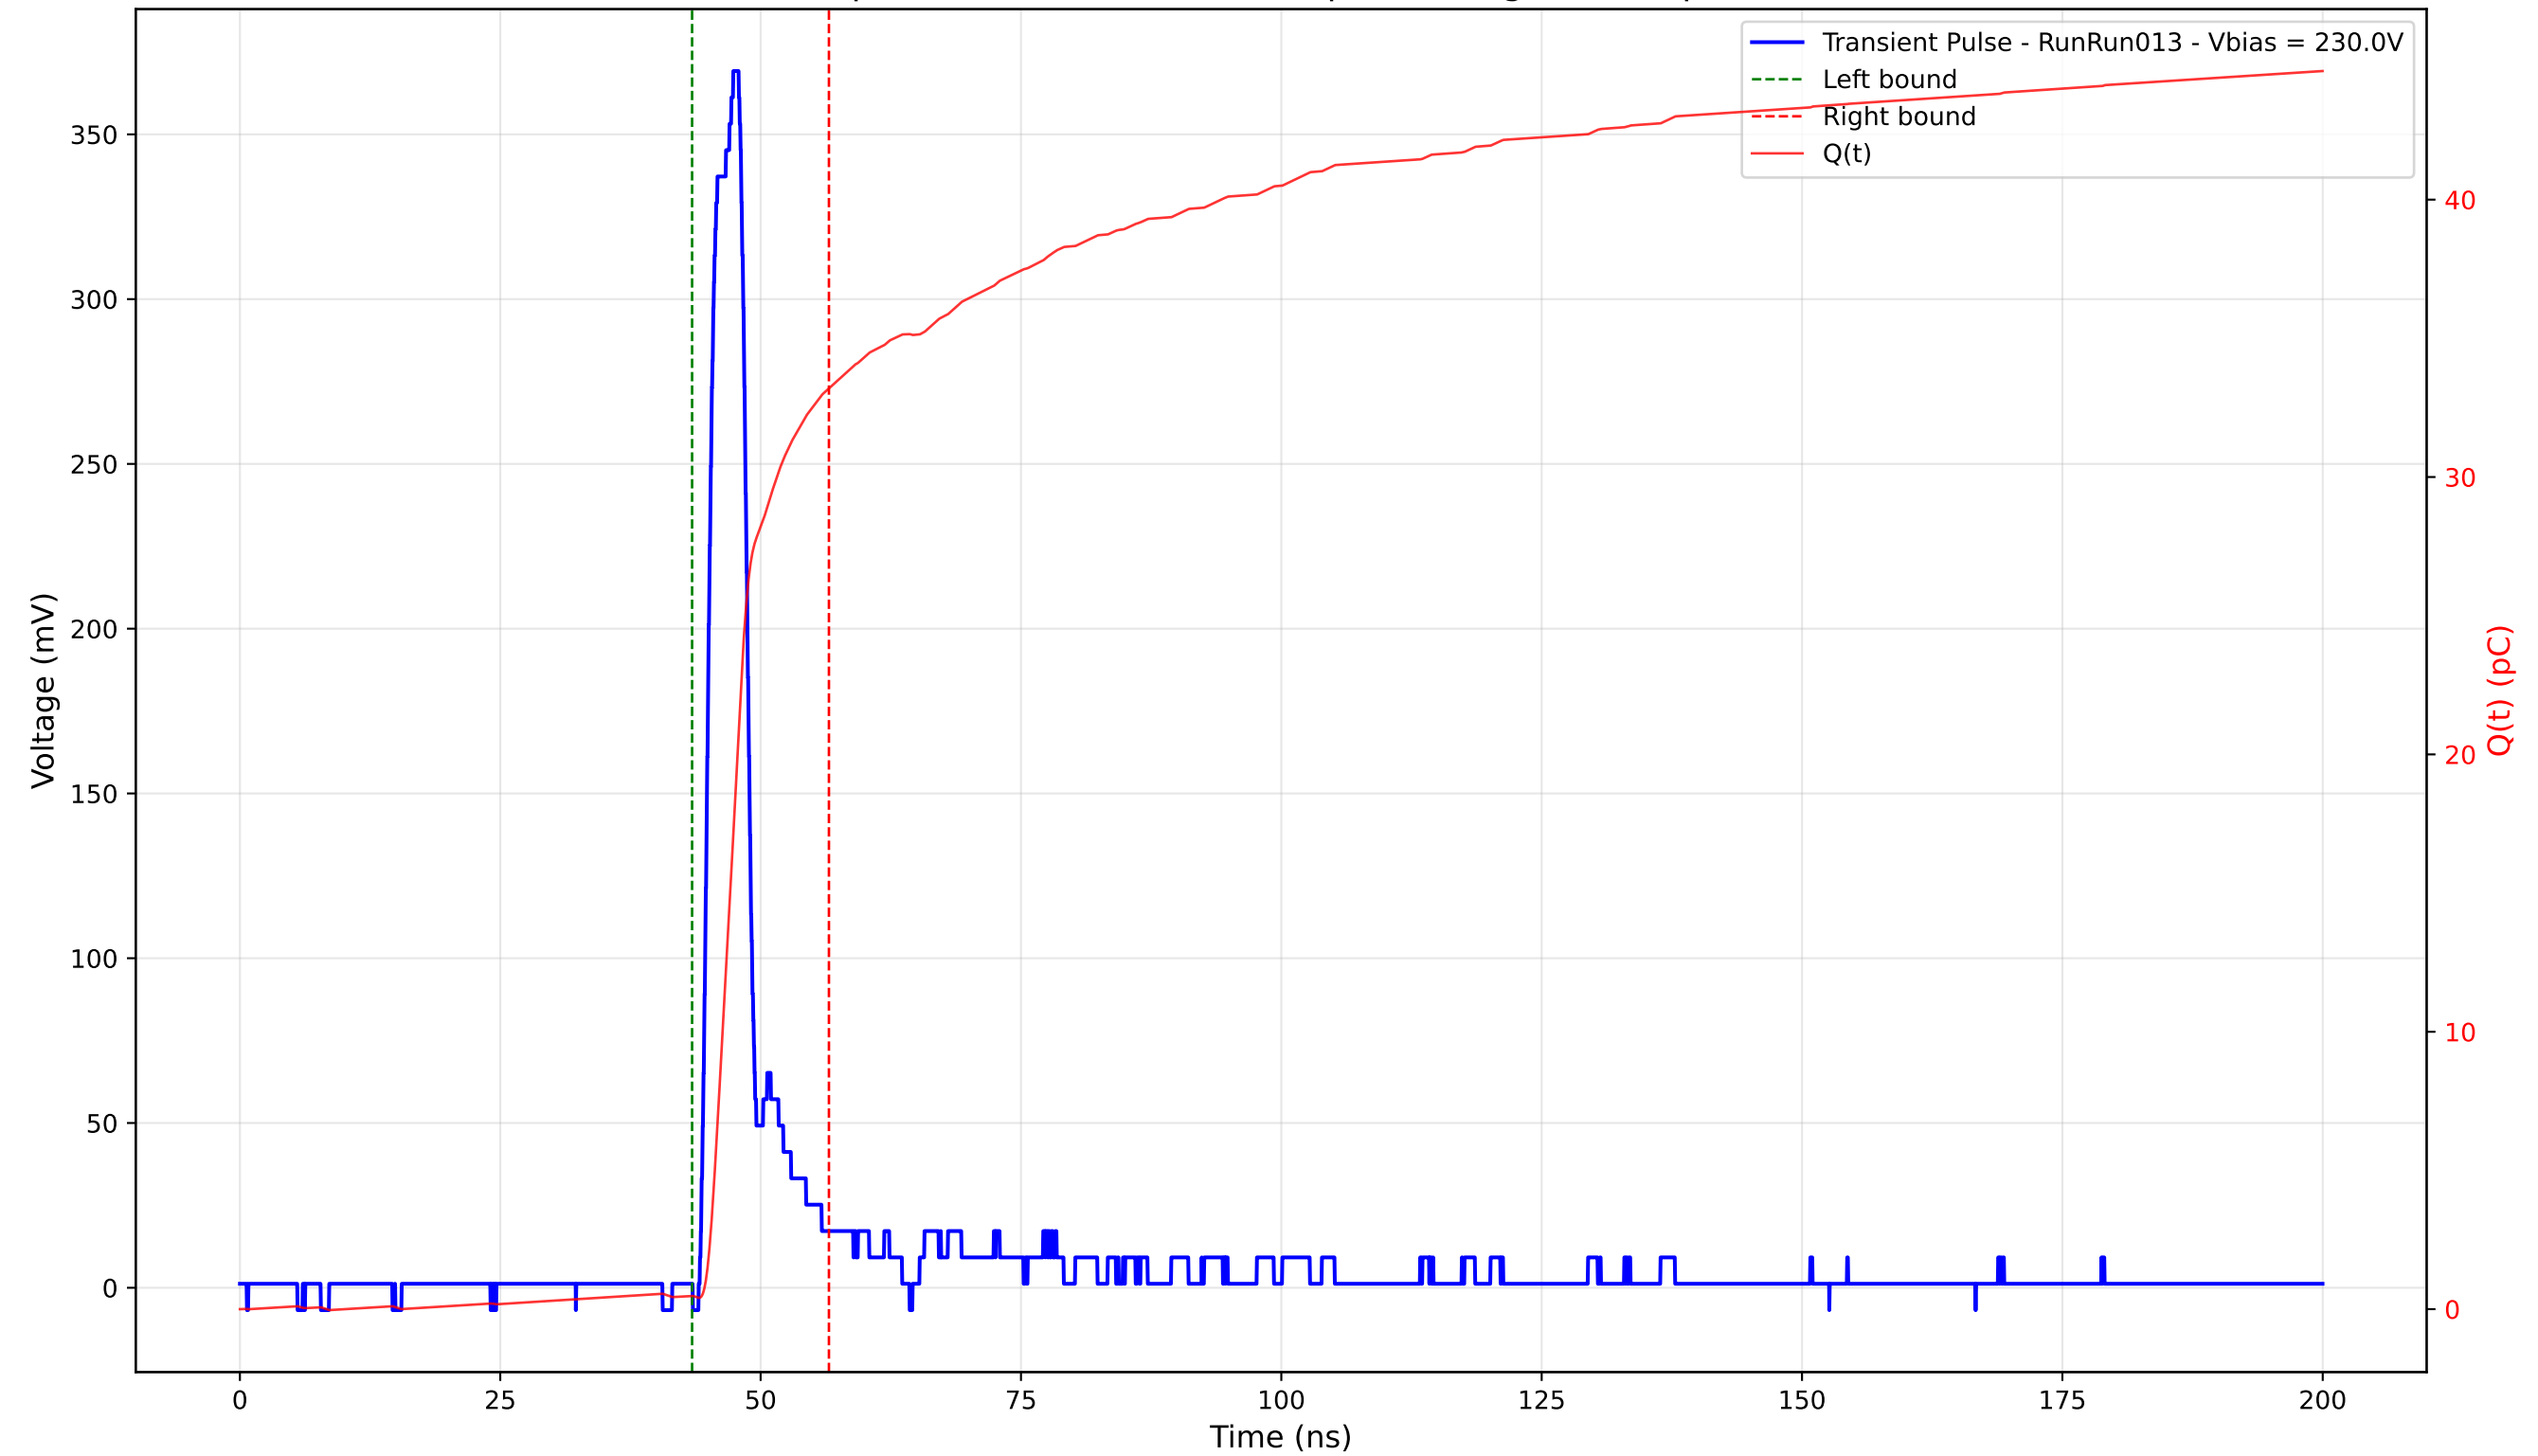


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 32.20 pC - Rise Time: 1.66 ns

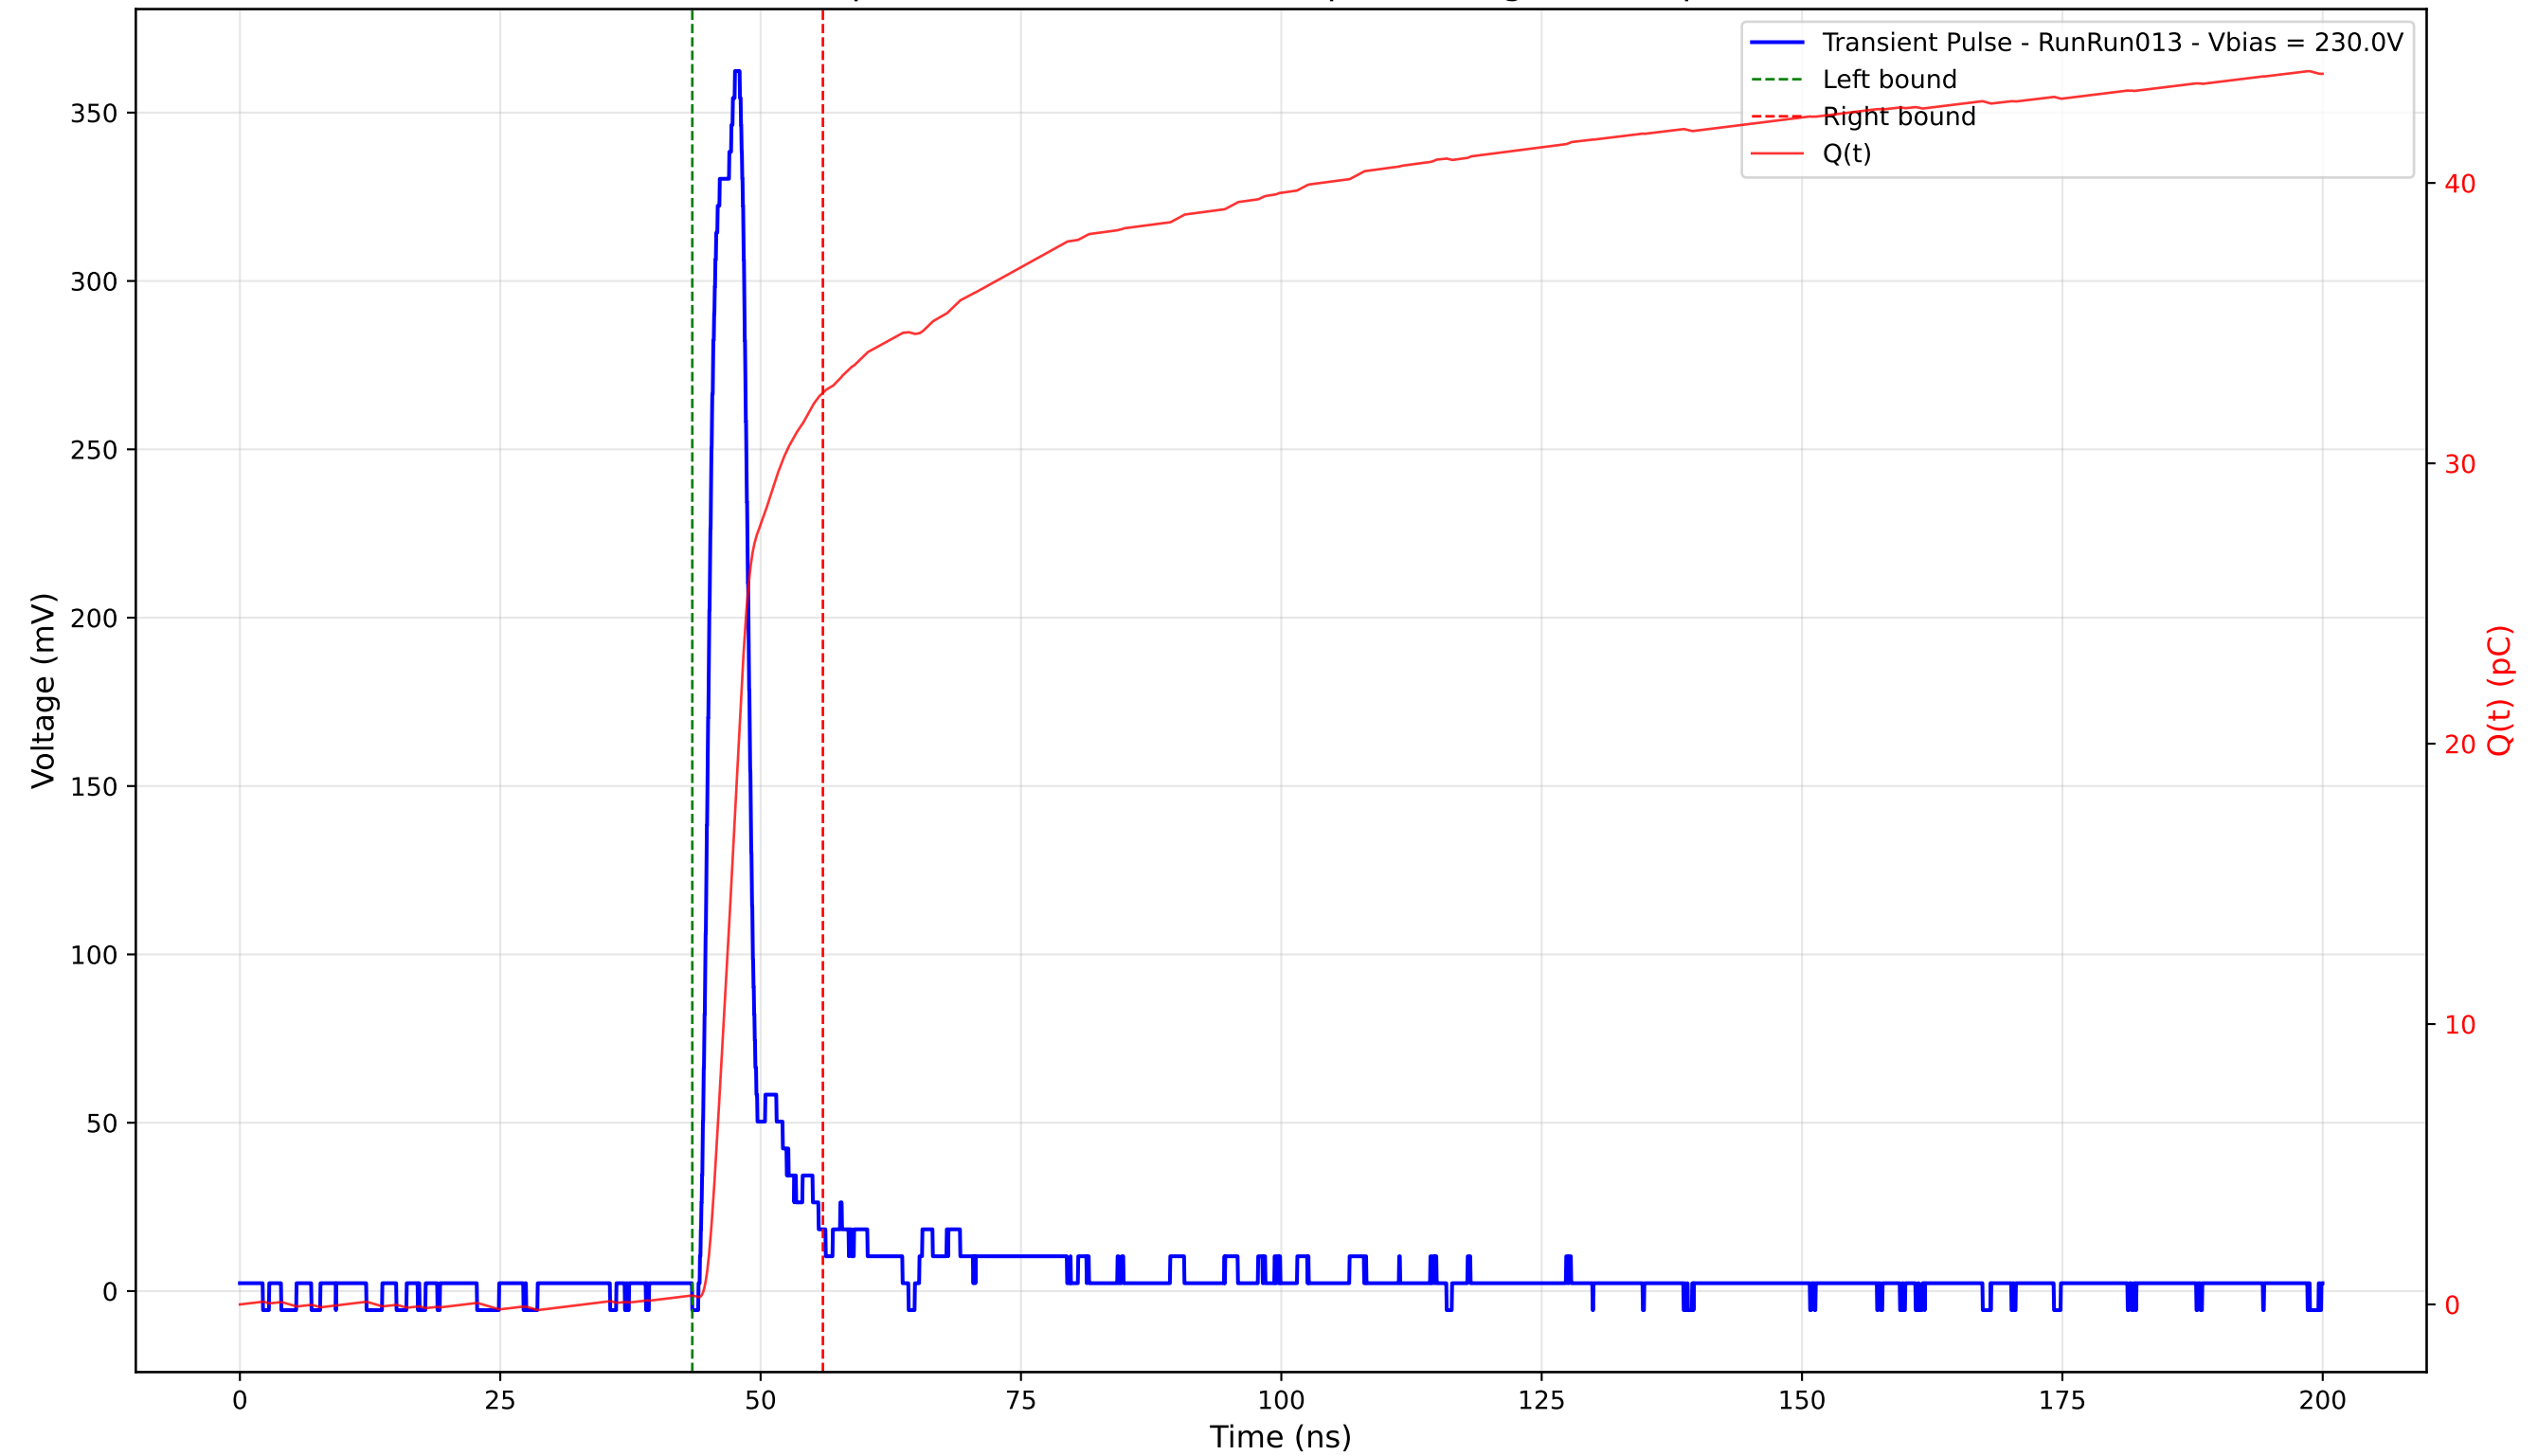


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 32.46 pC - Rise Time: 2.69 ns

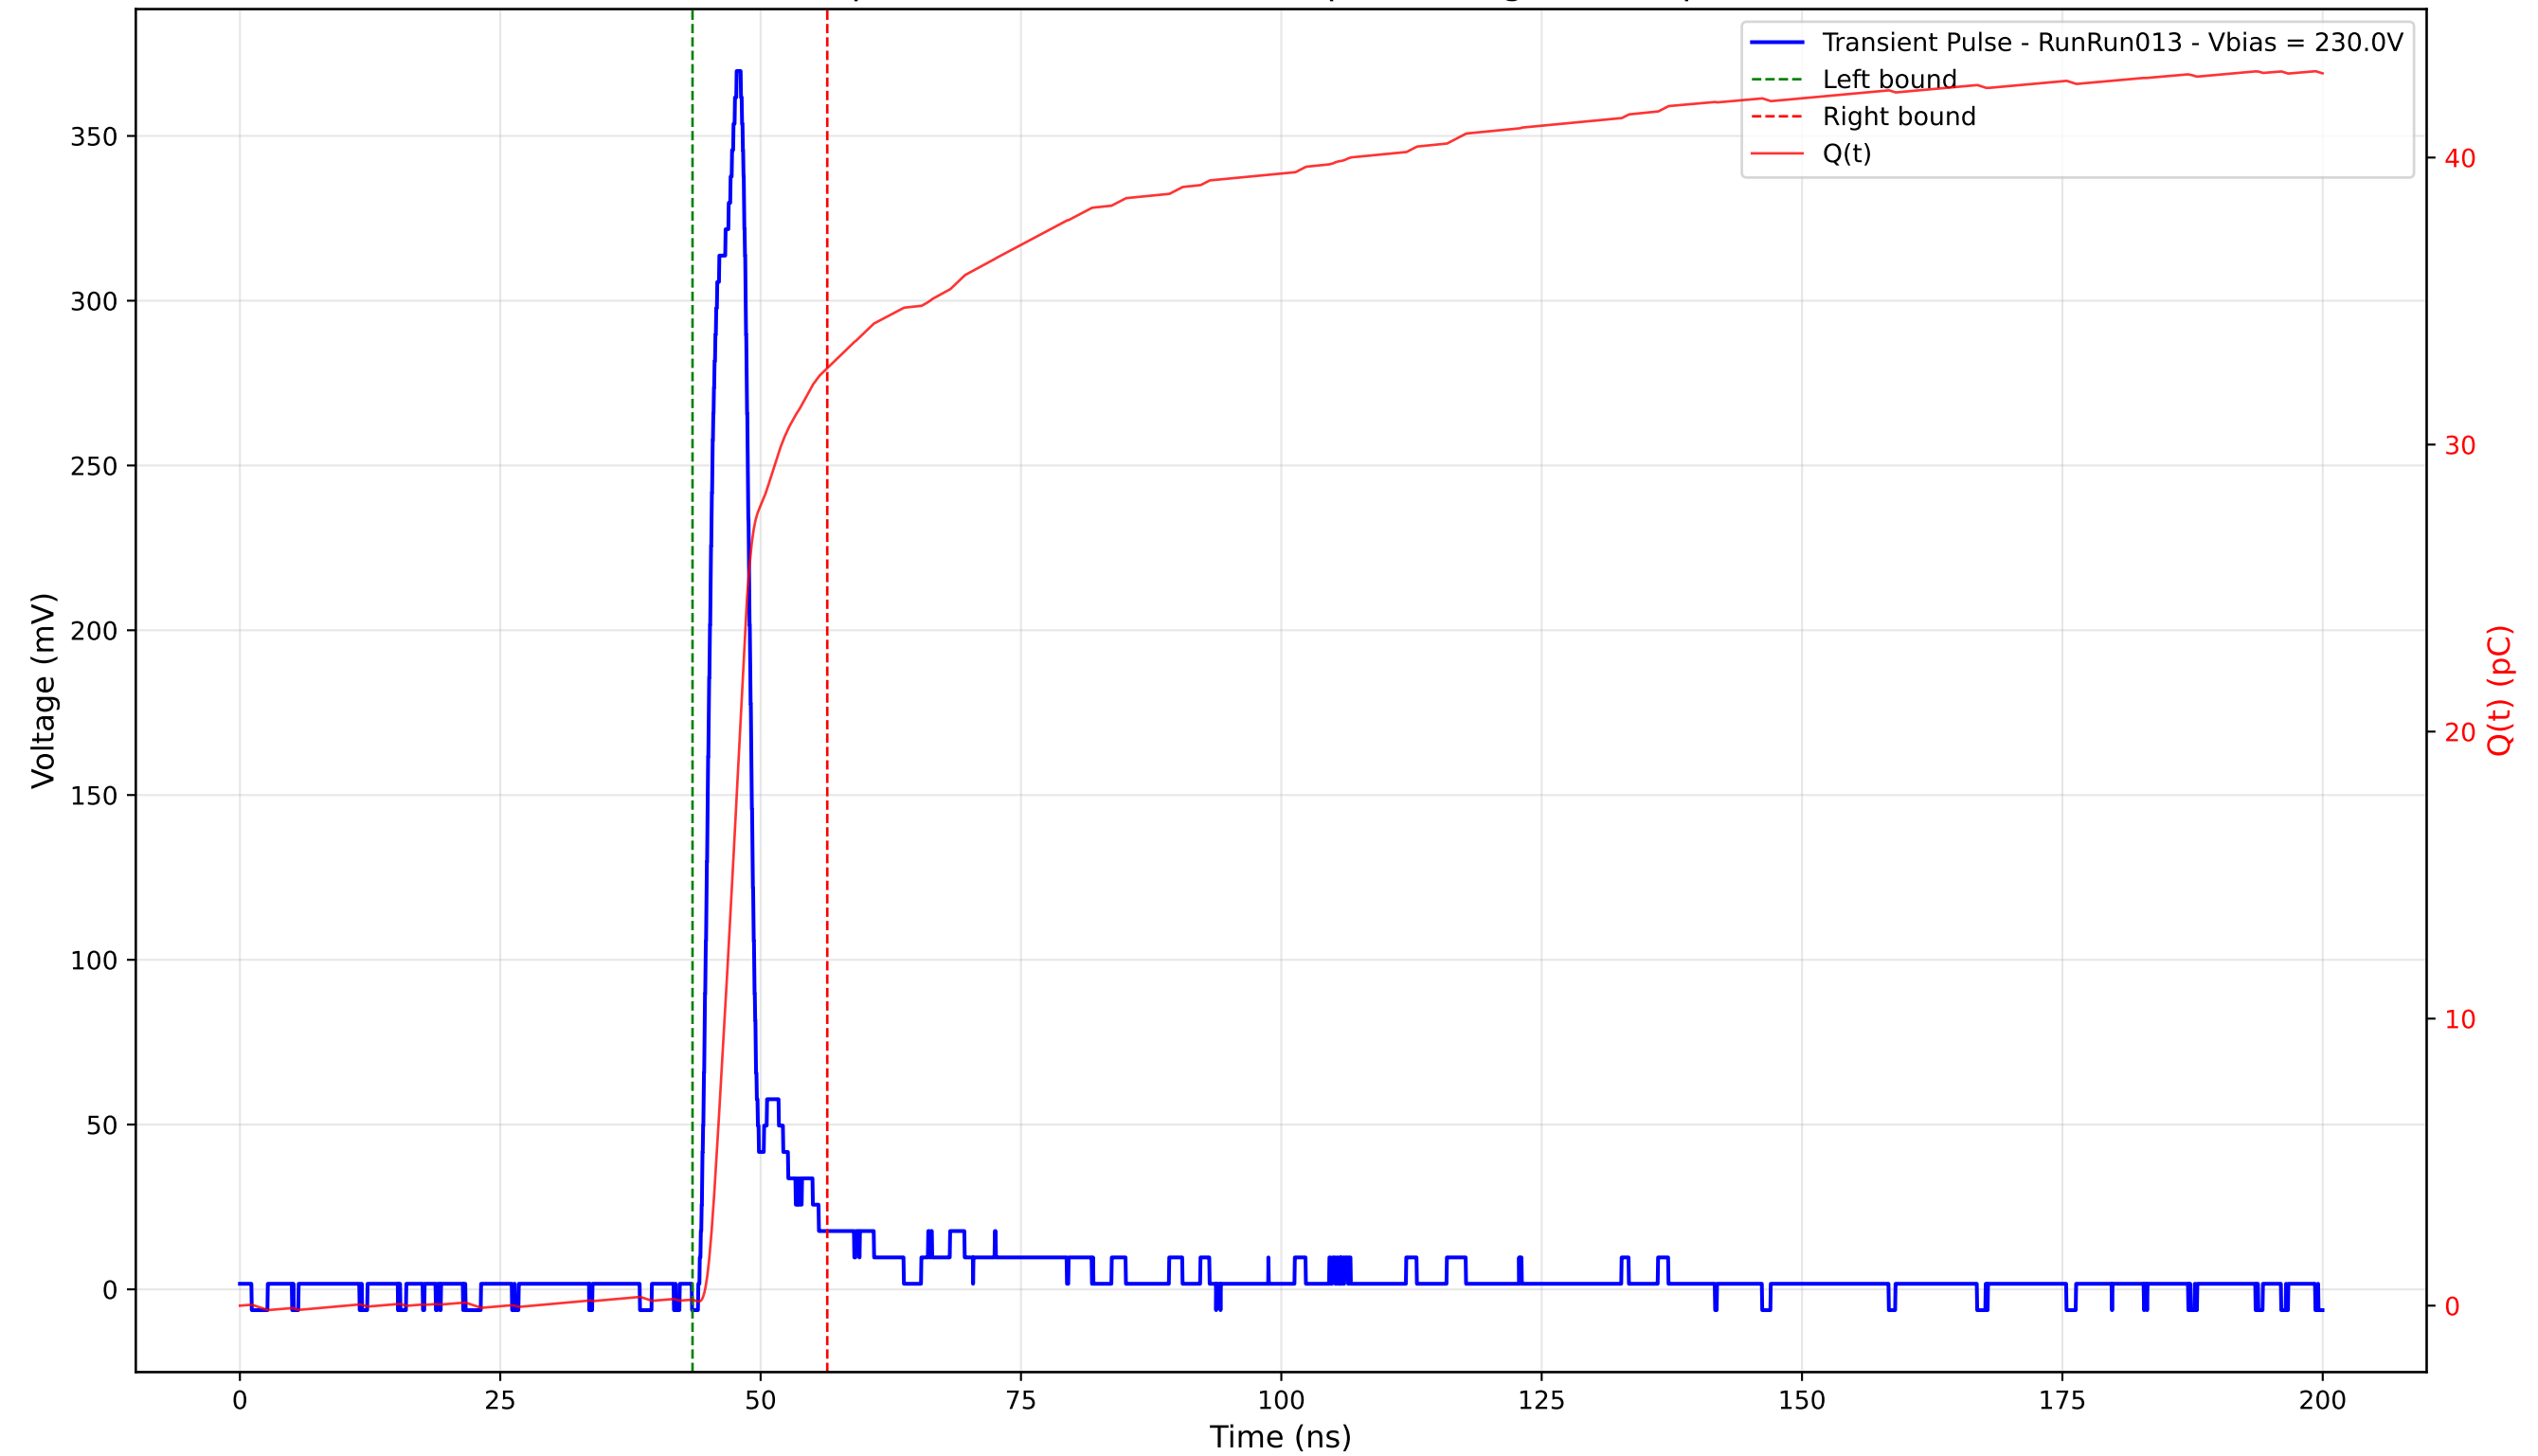


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 31.67 pC - Rise Time: 2.87 ns

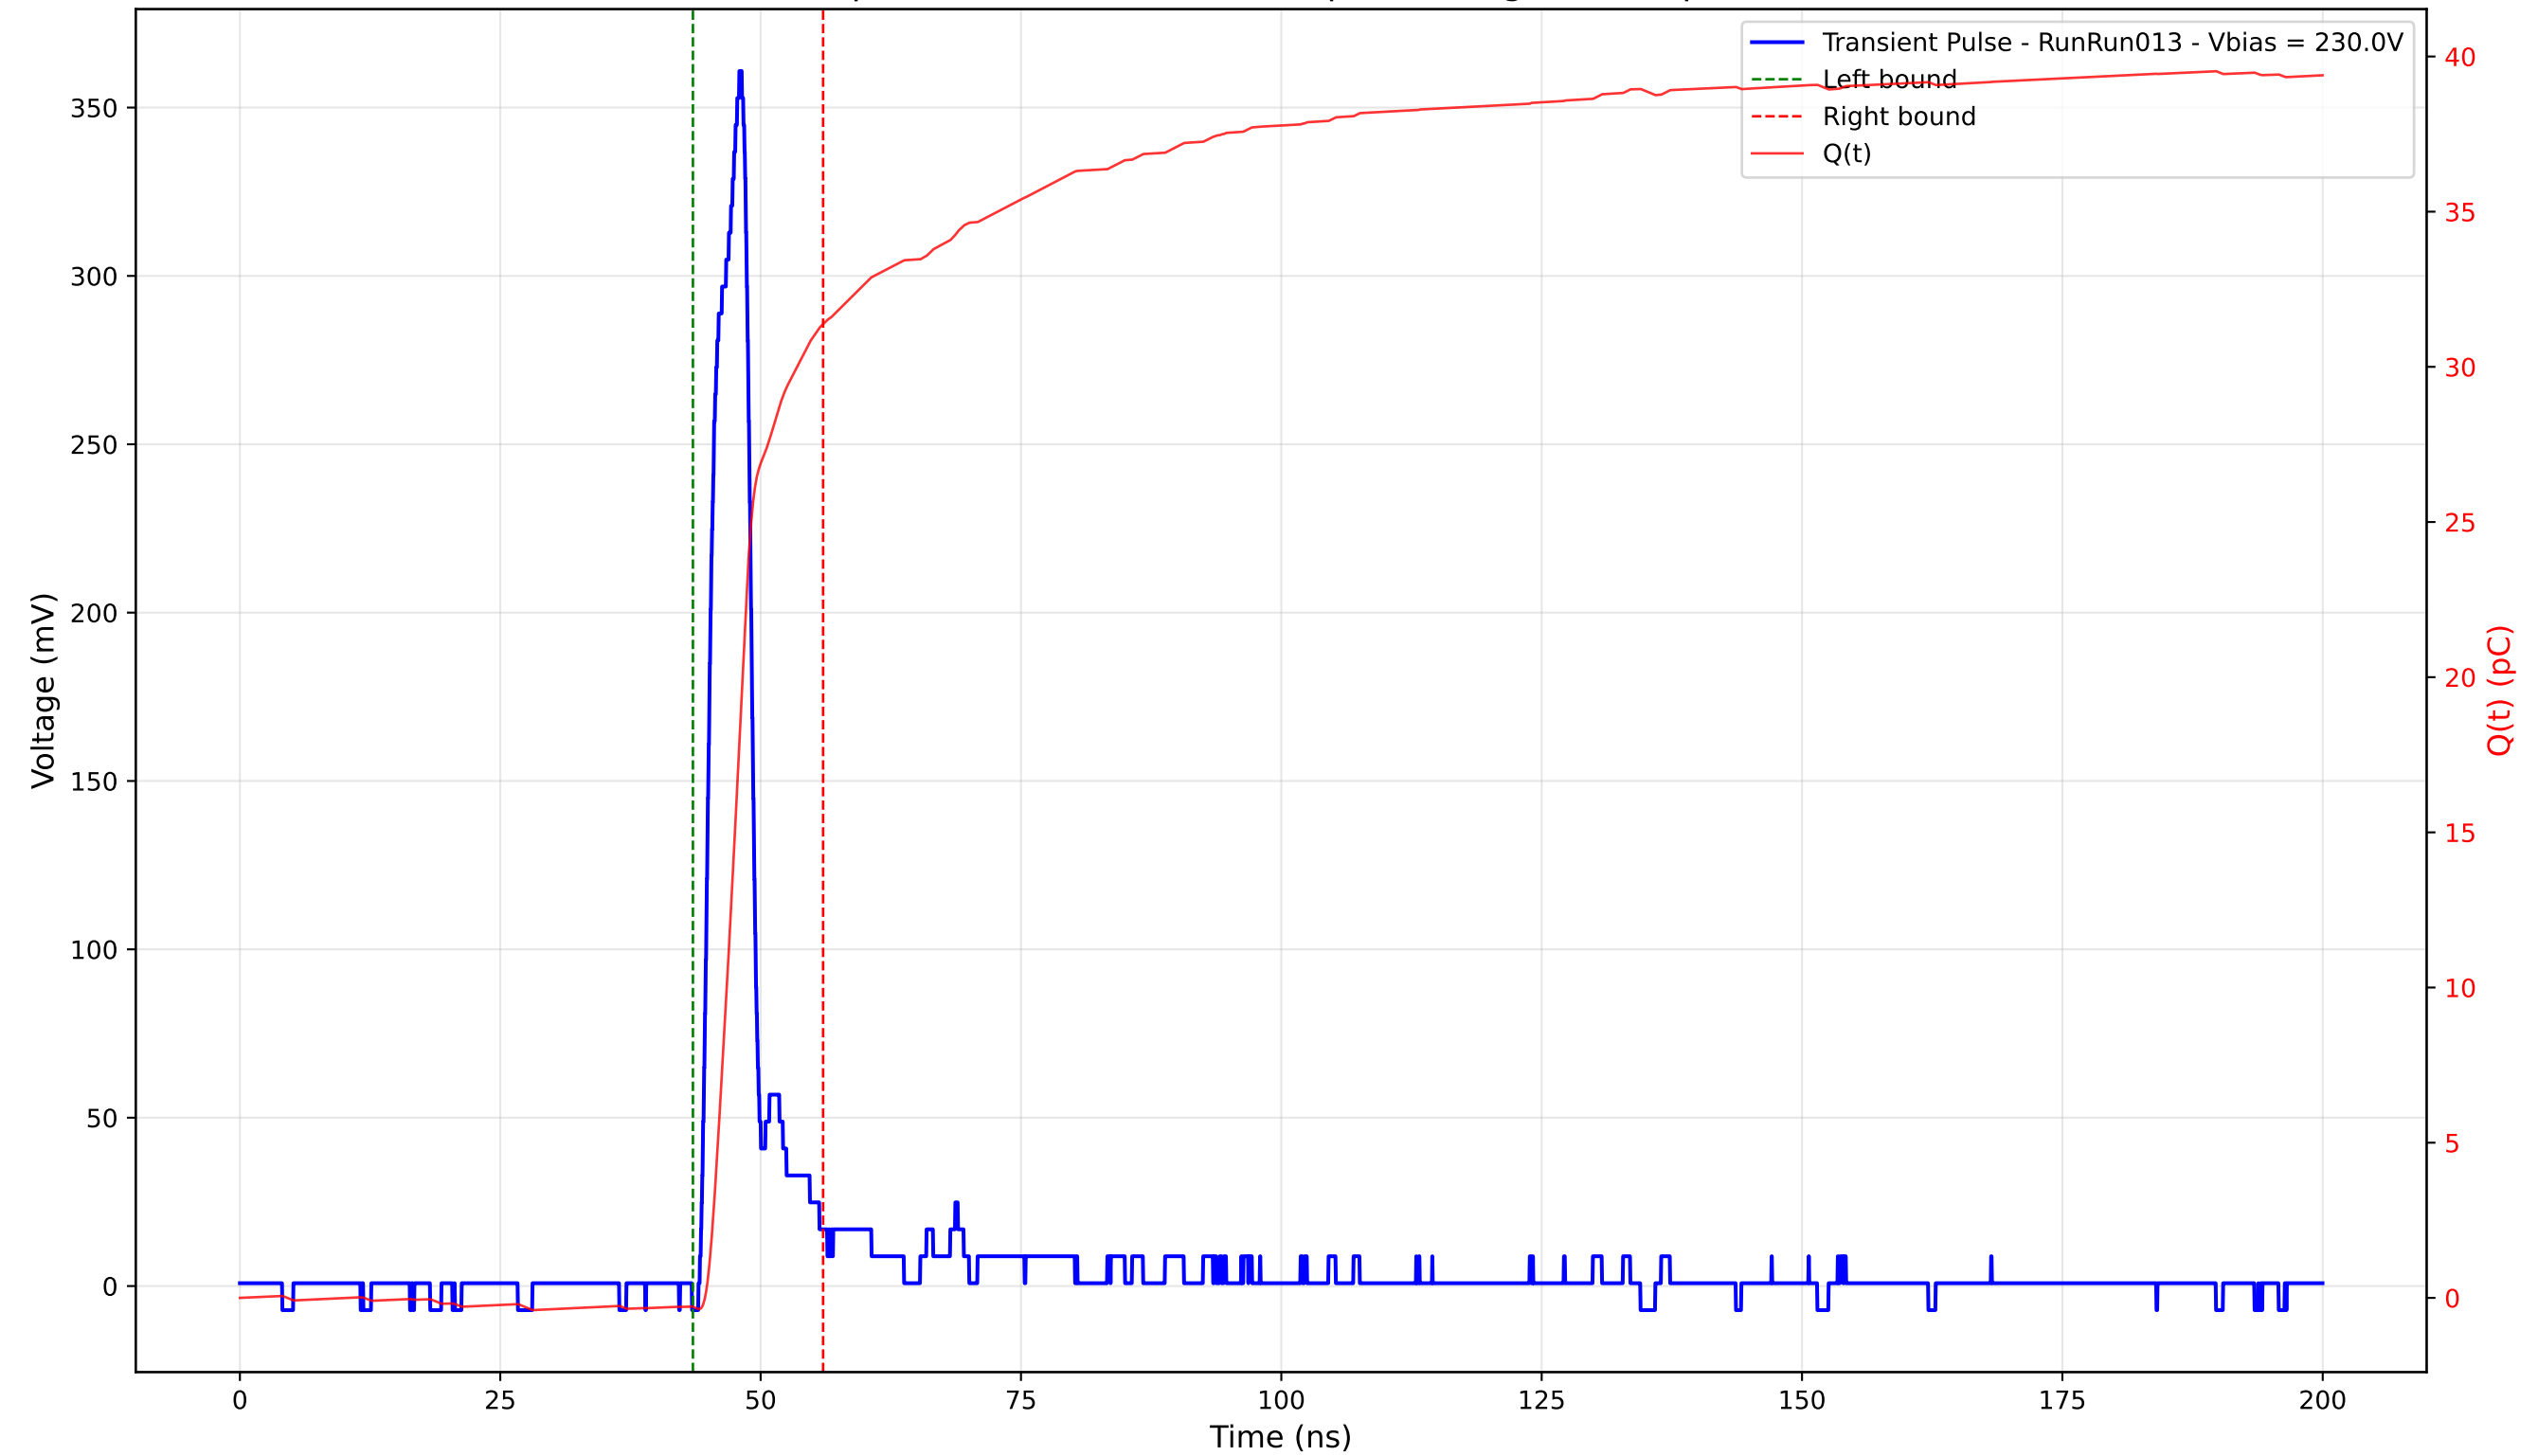


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 32.05 pC - Rise Time: 3.03 ns

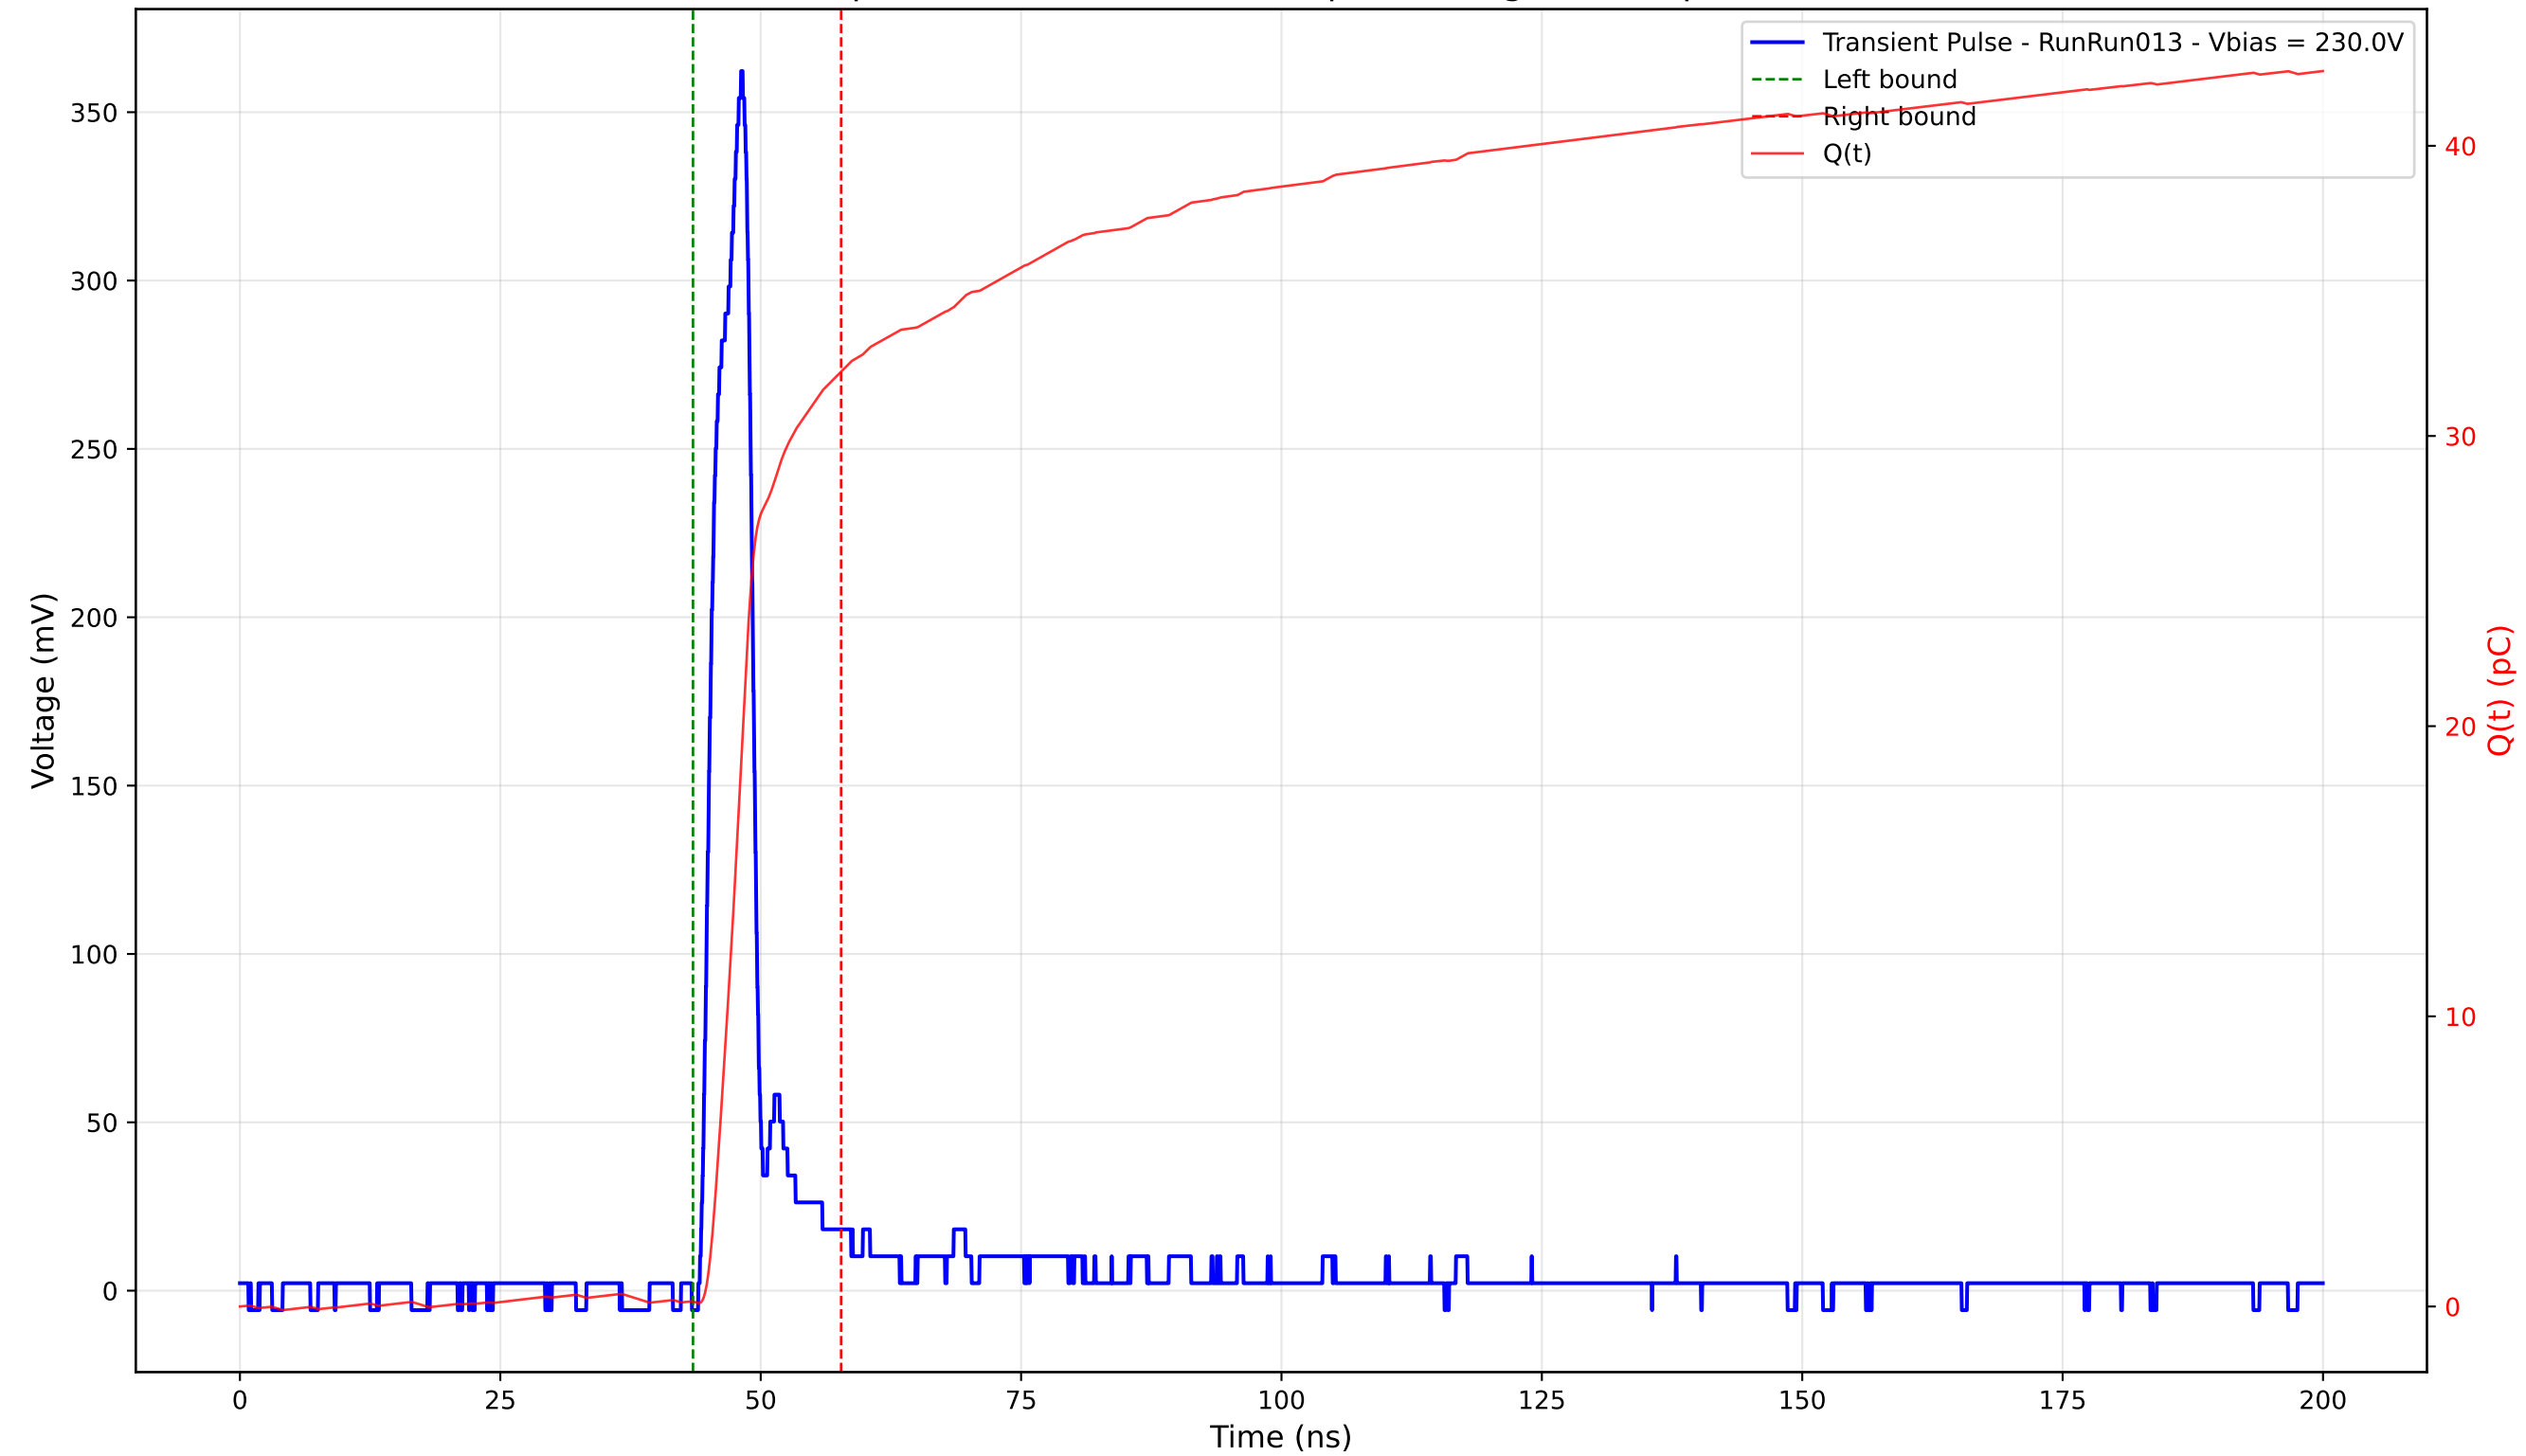


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 32.33 pC - Rise Time: 3.06 ns

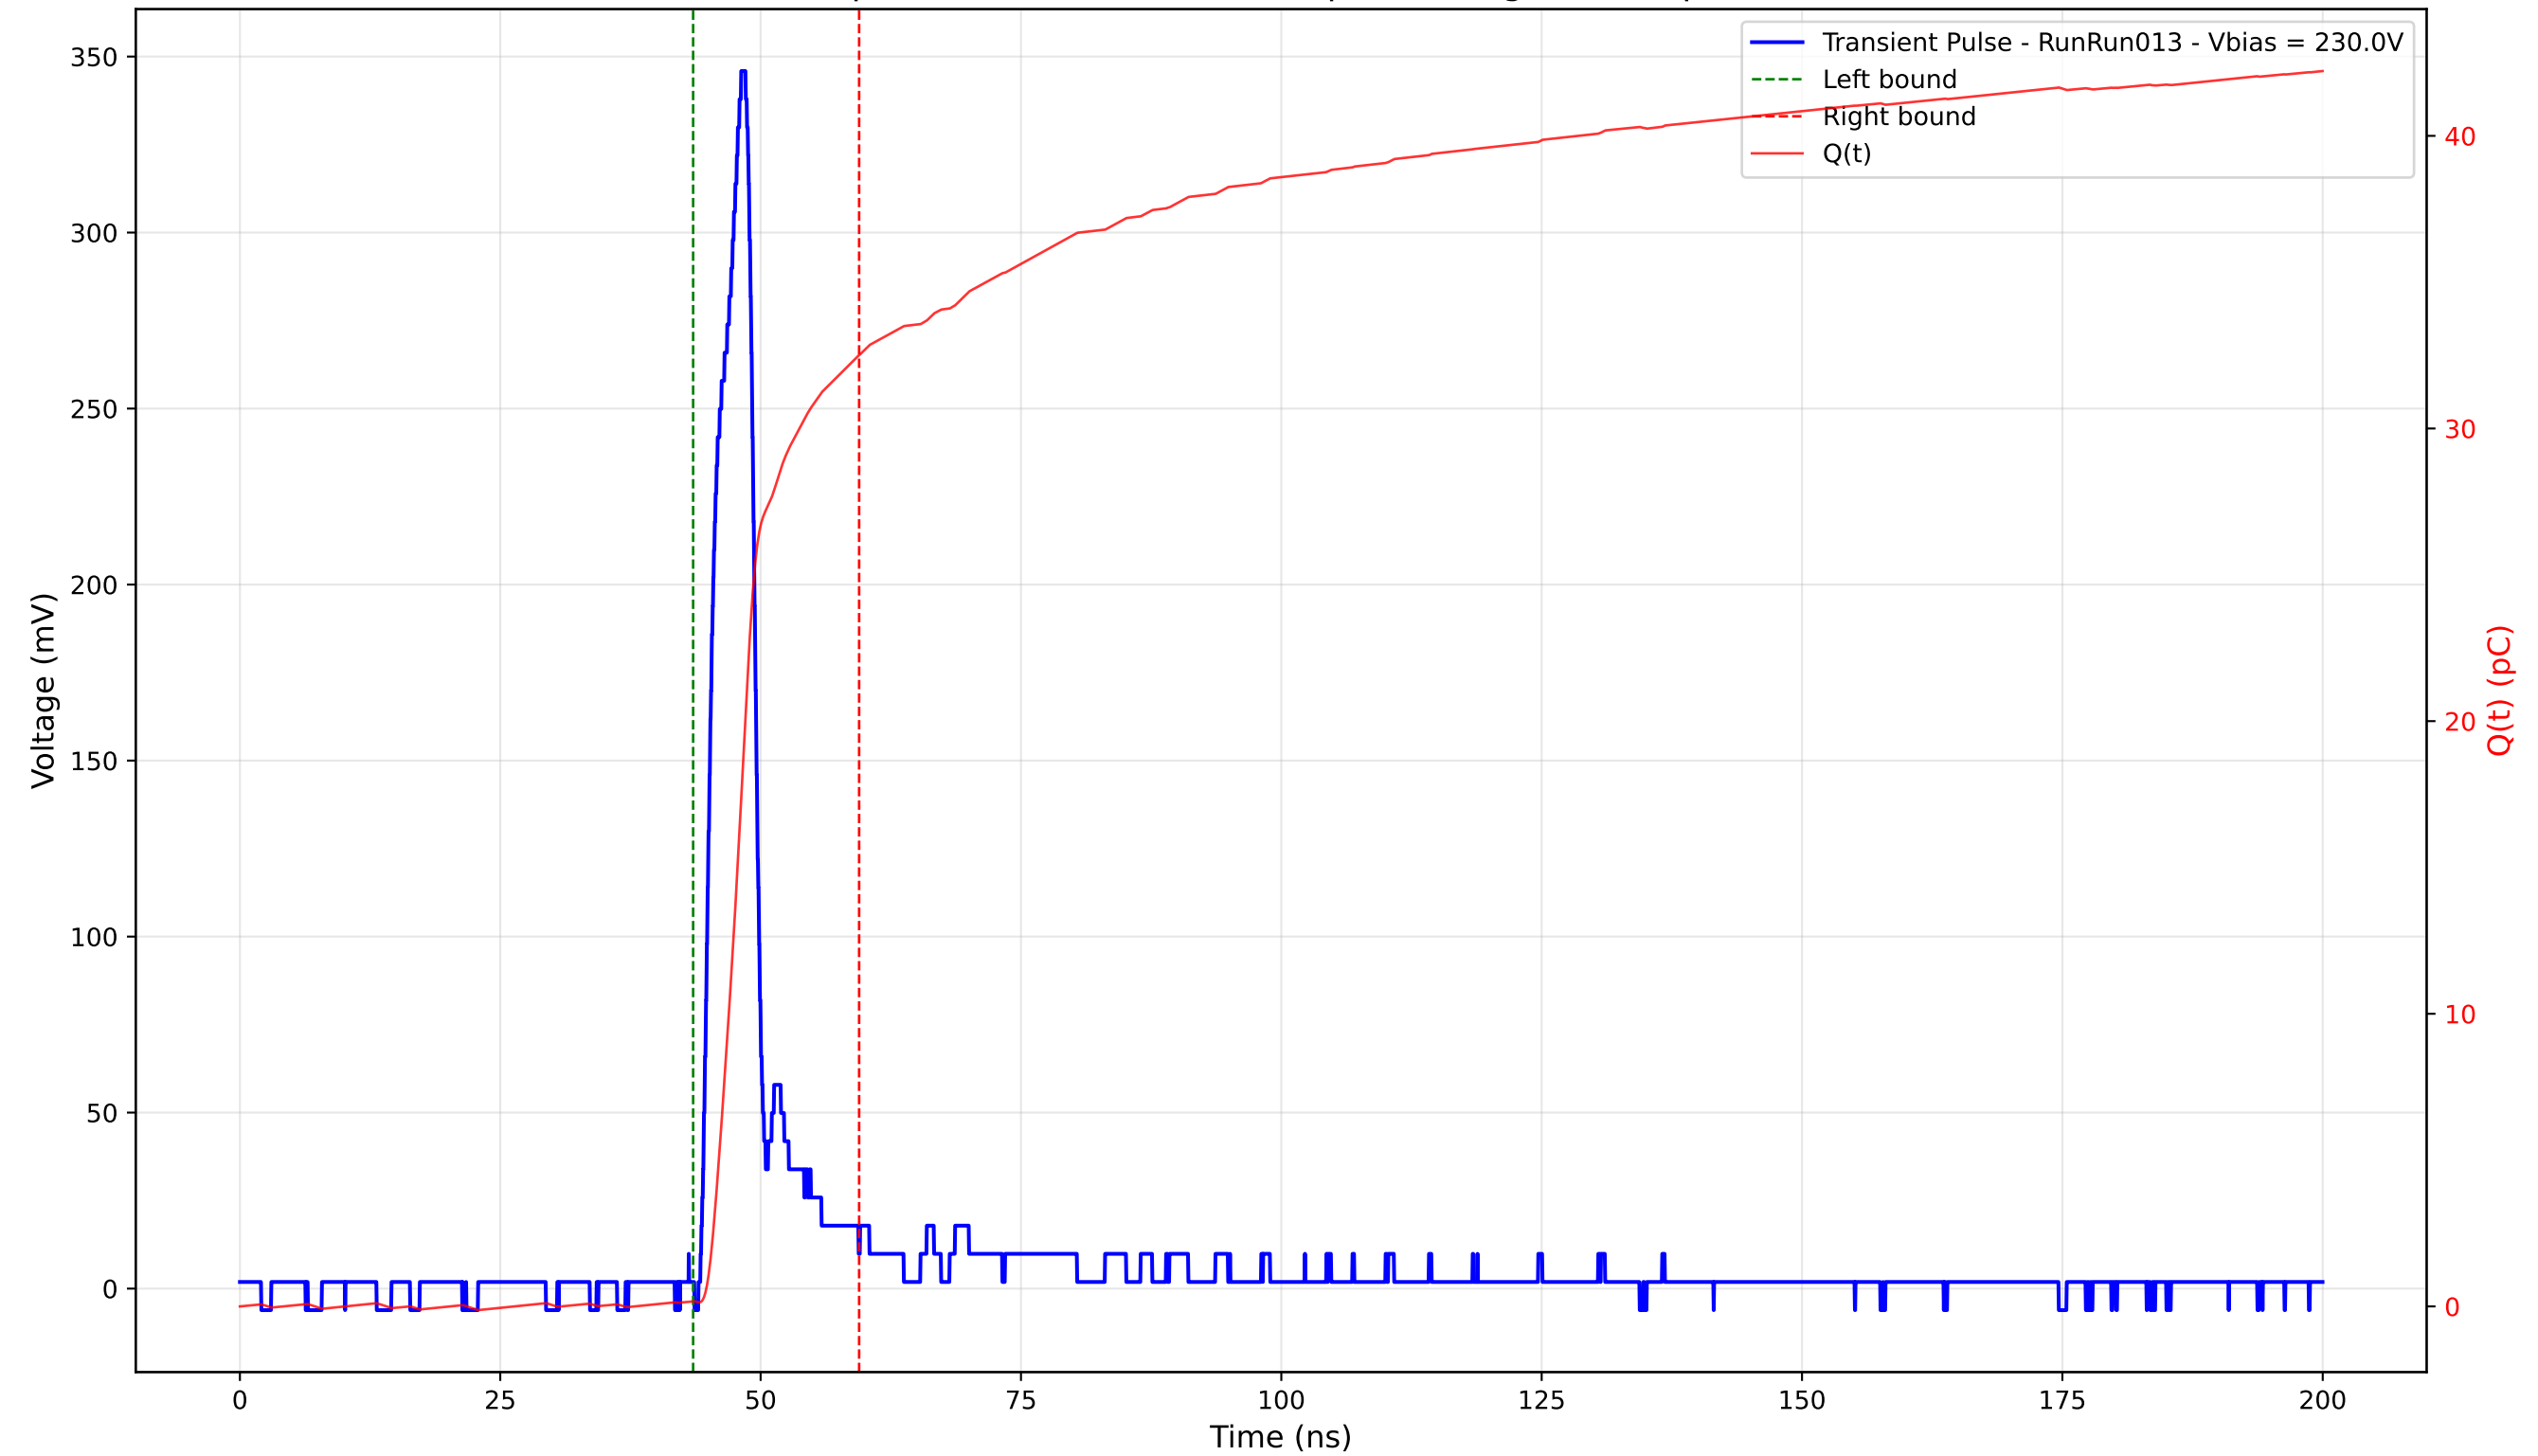


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 30.55 pC - Rise Time: 3.18 ns

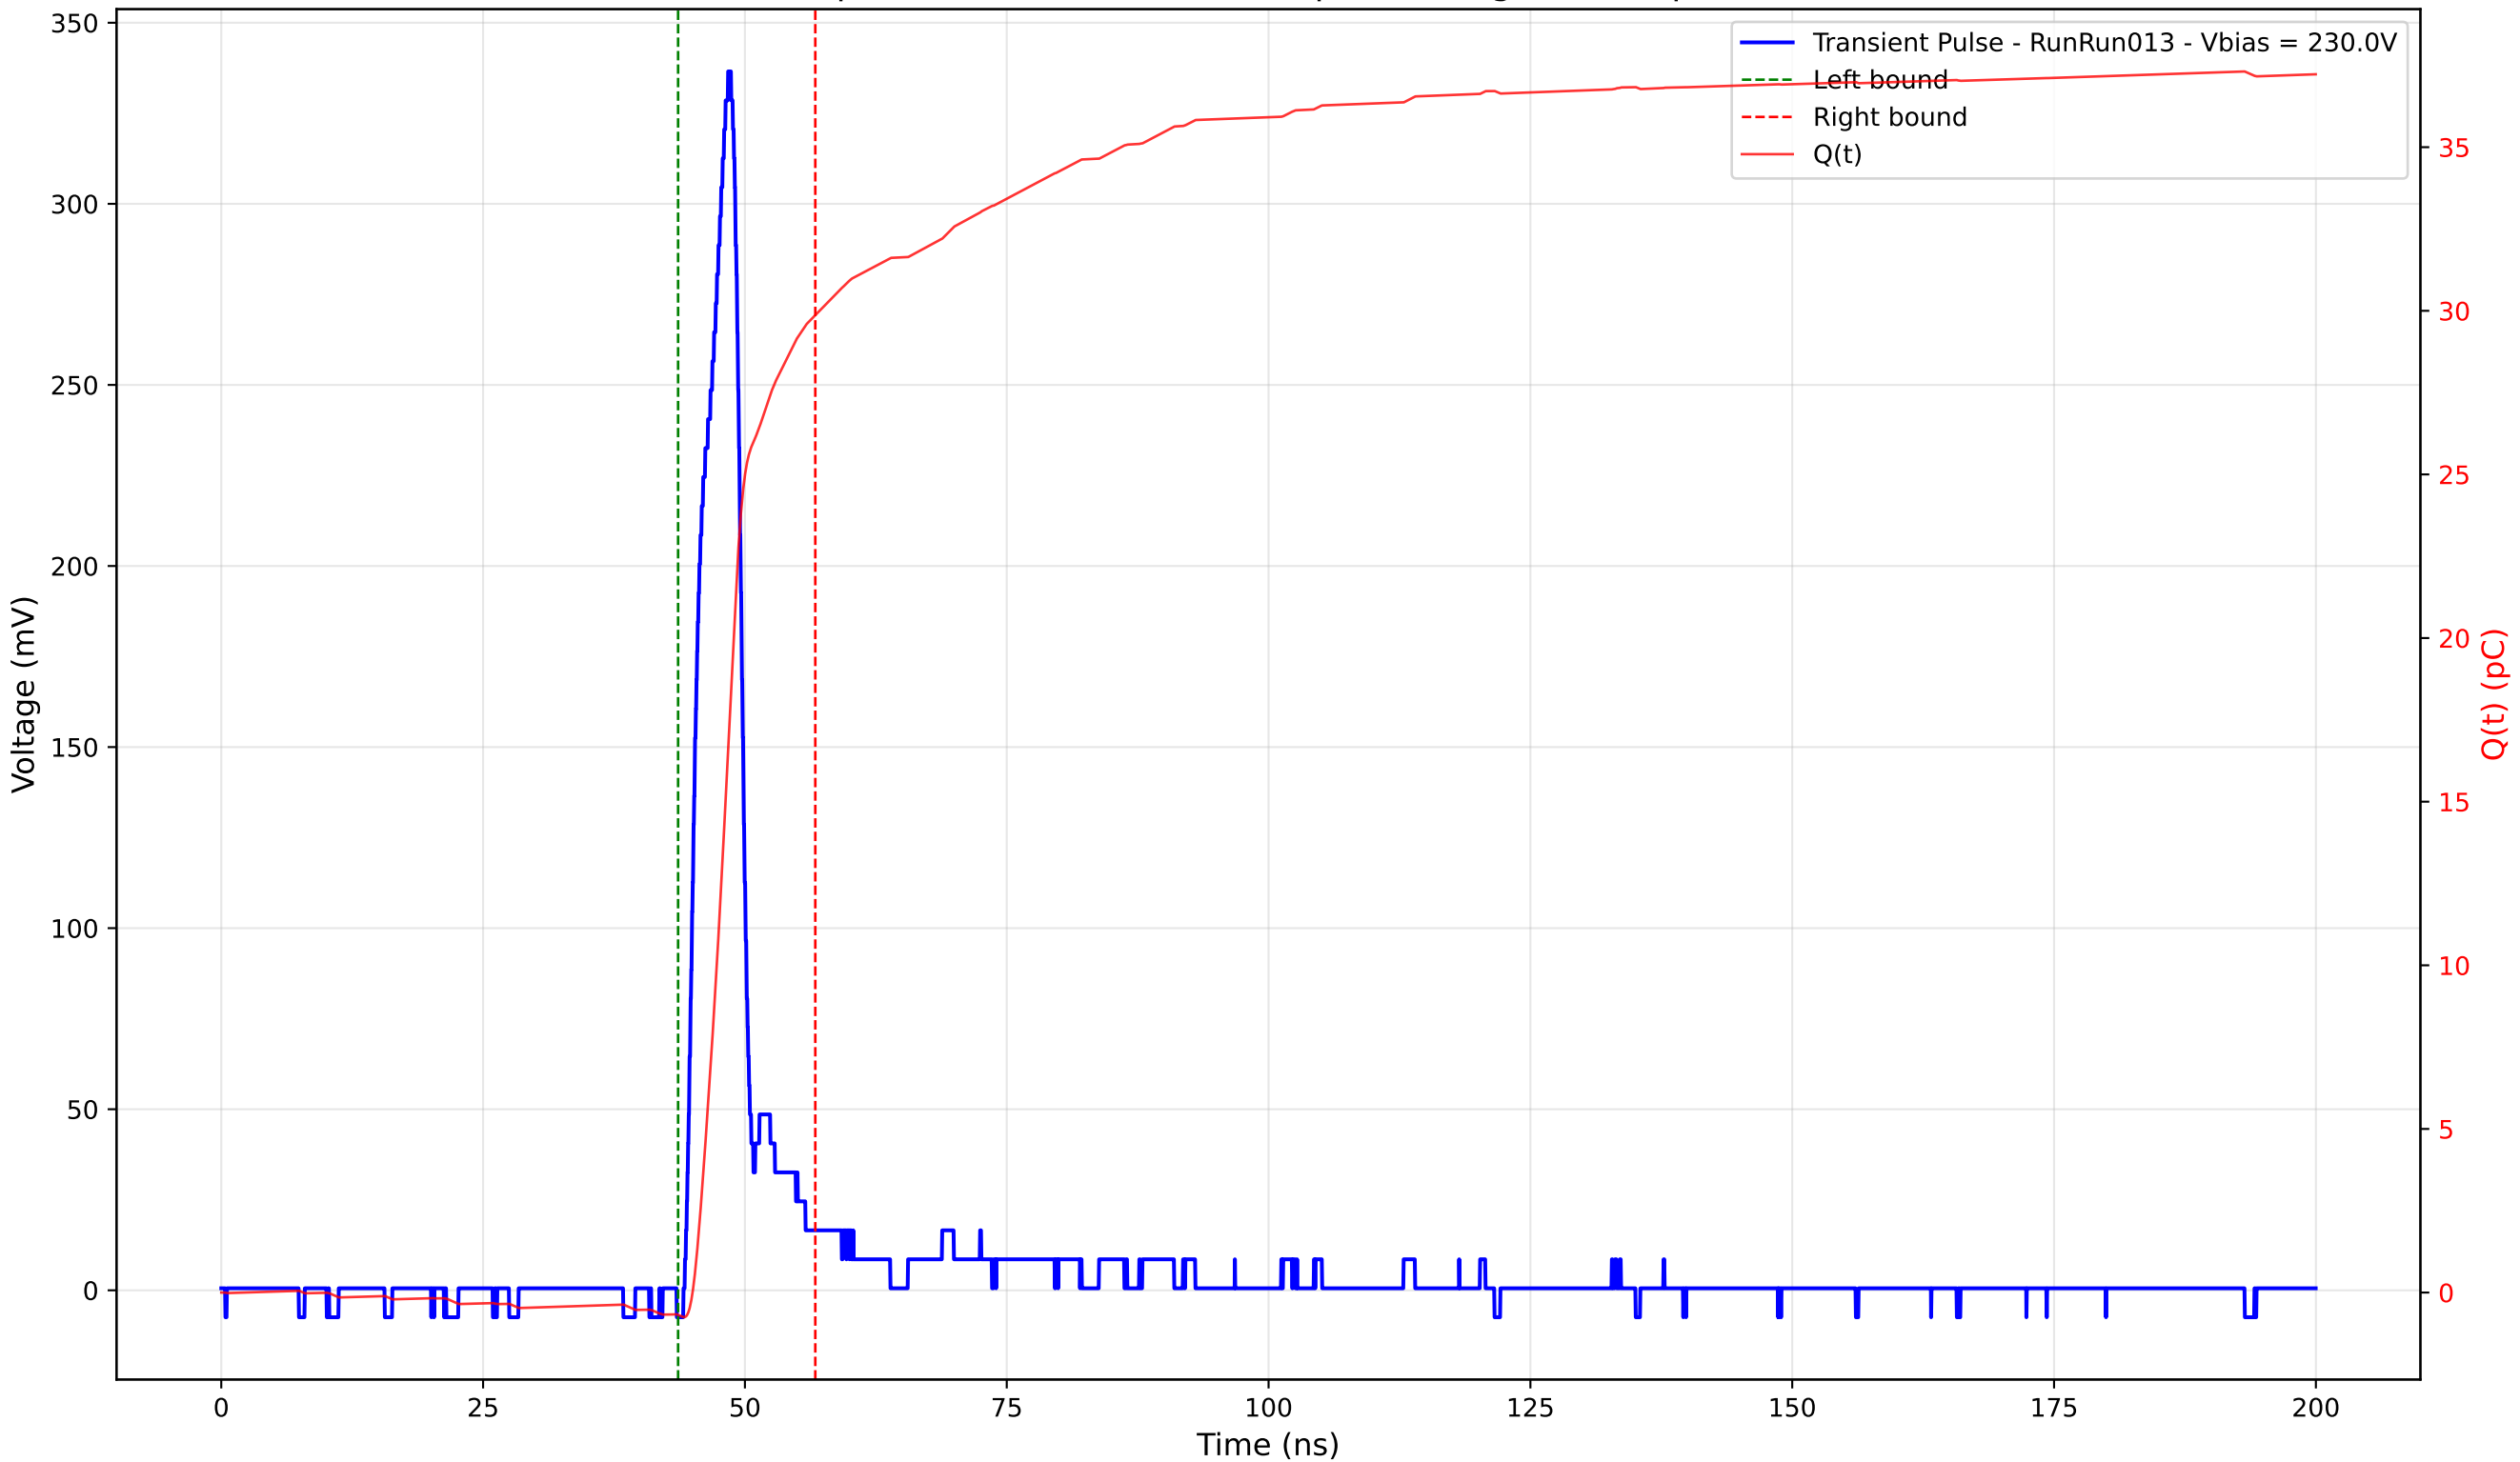


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 29.83 pC - Rise Time: 3.42 ns

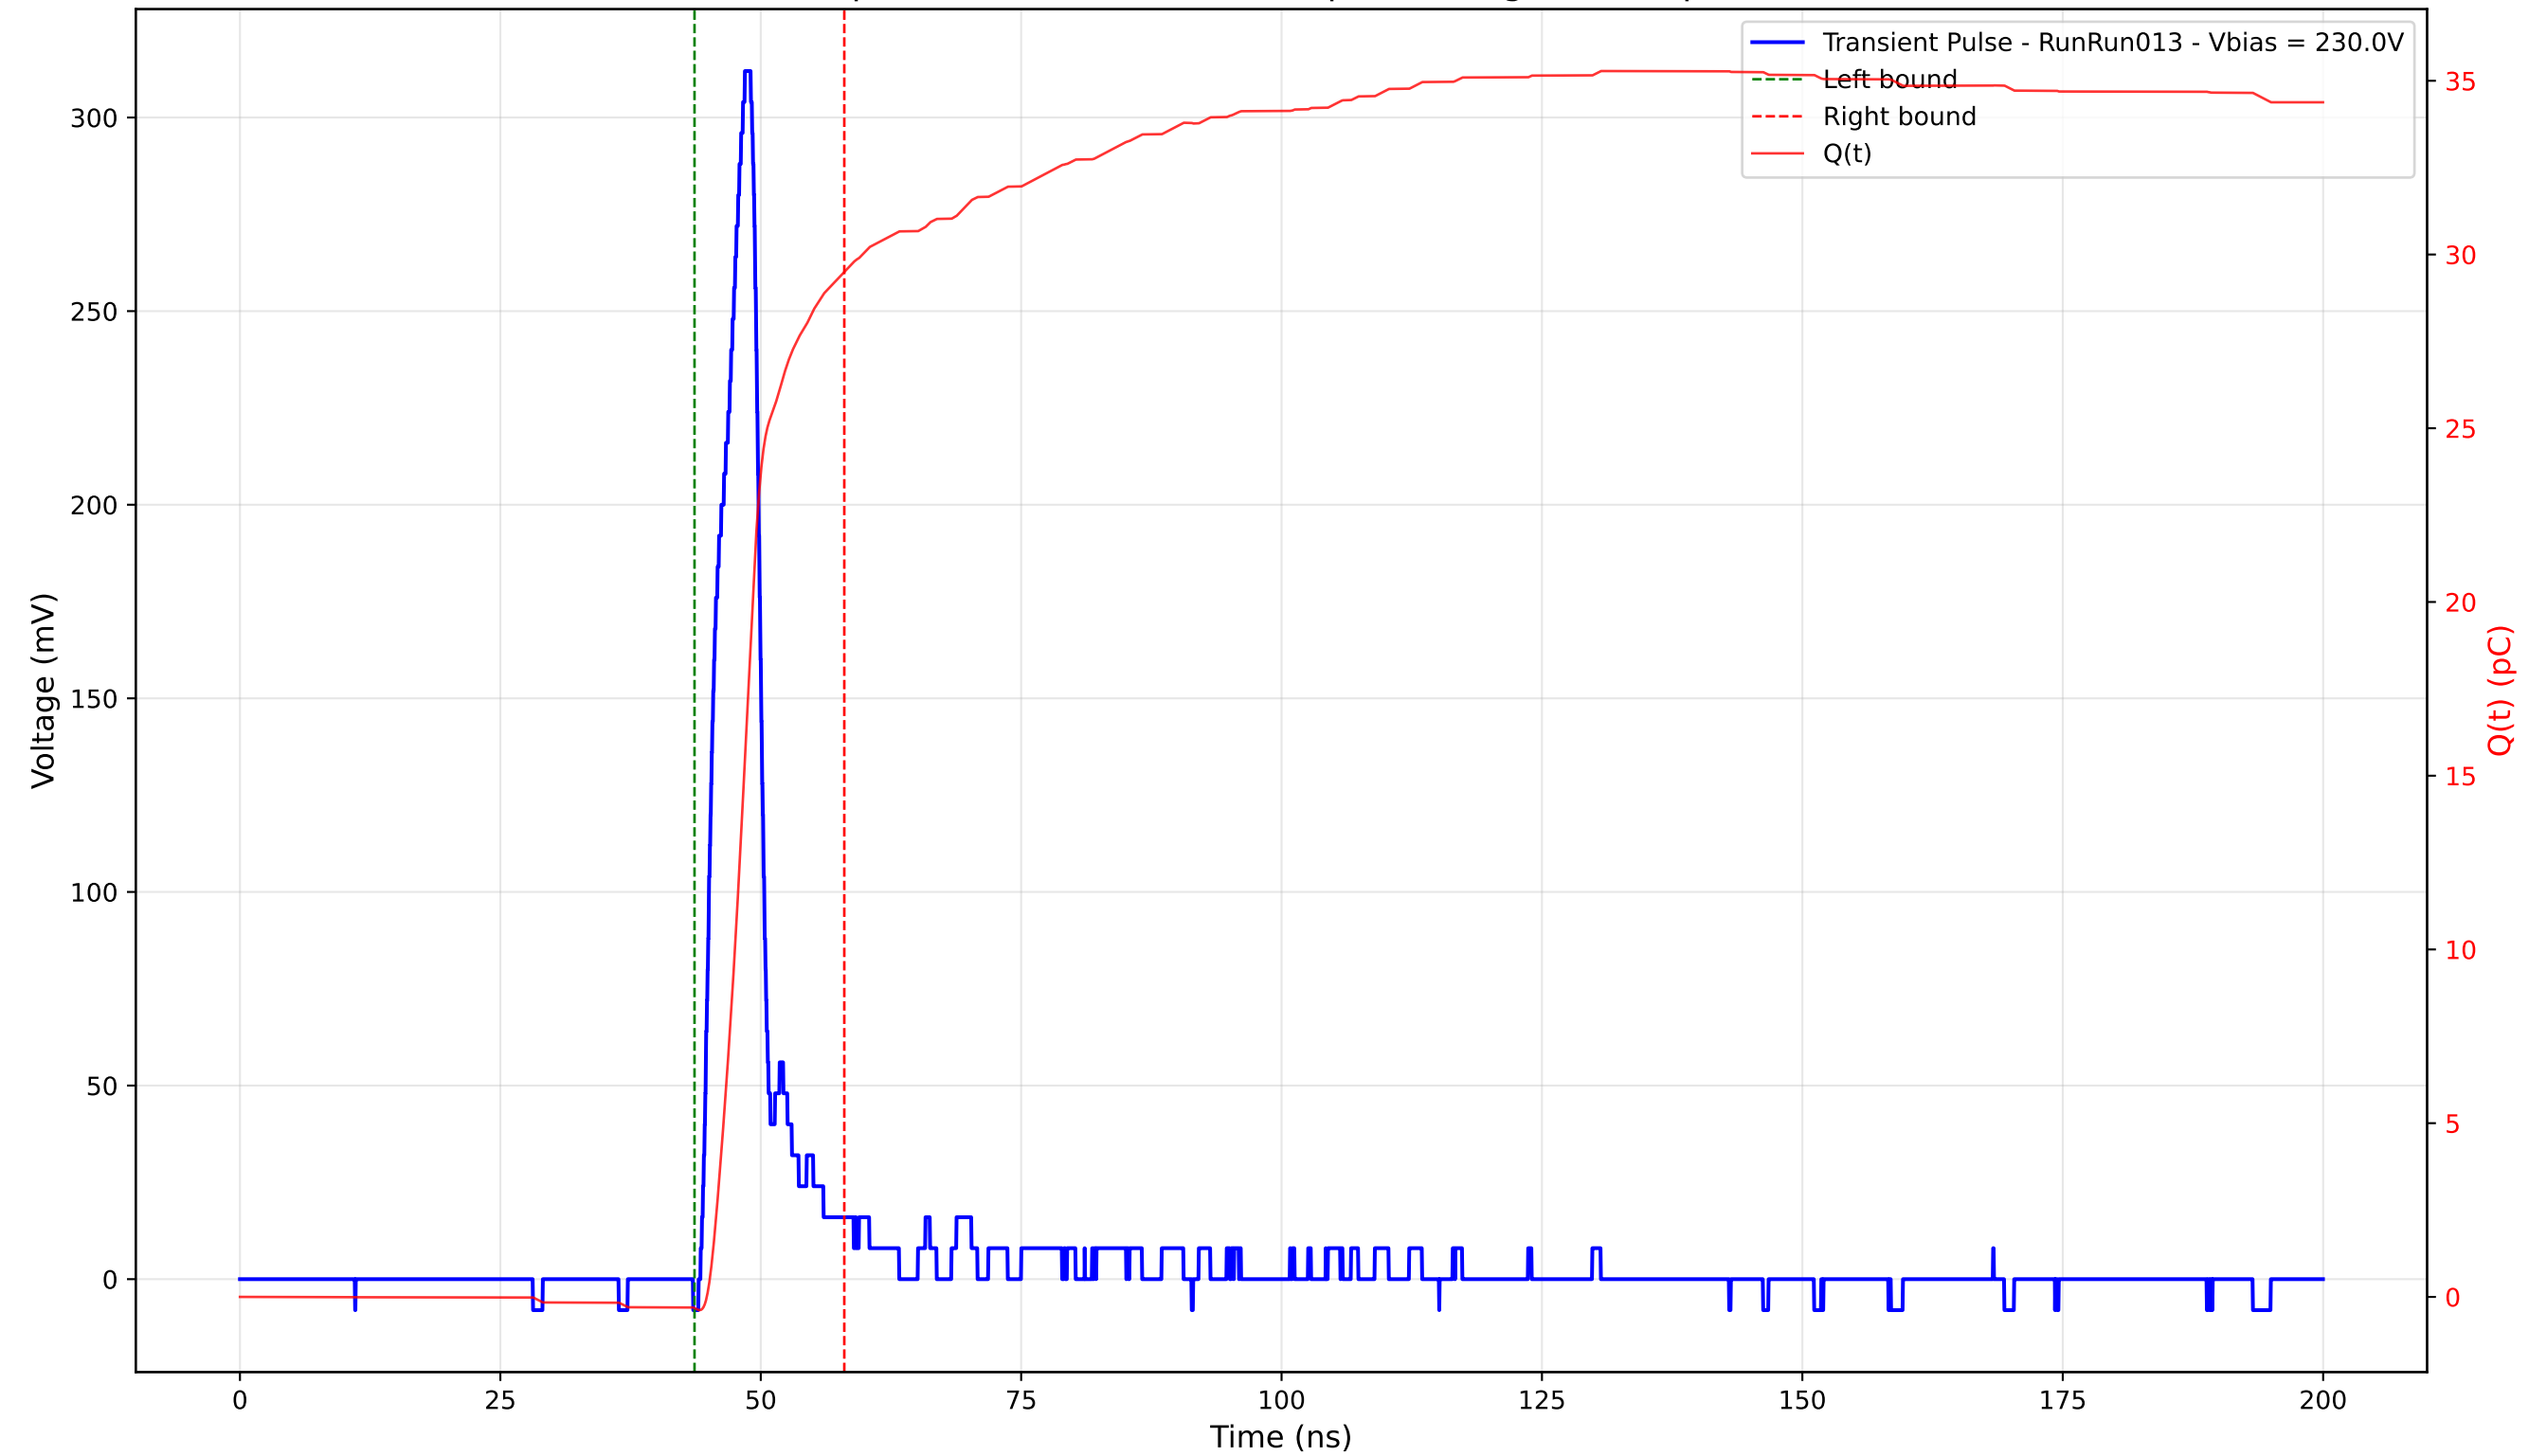


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 30.54 pC - Rise Time: 3.54 ns

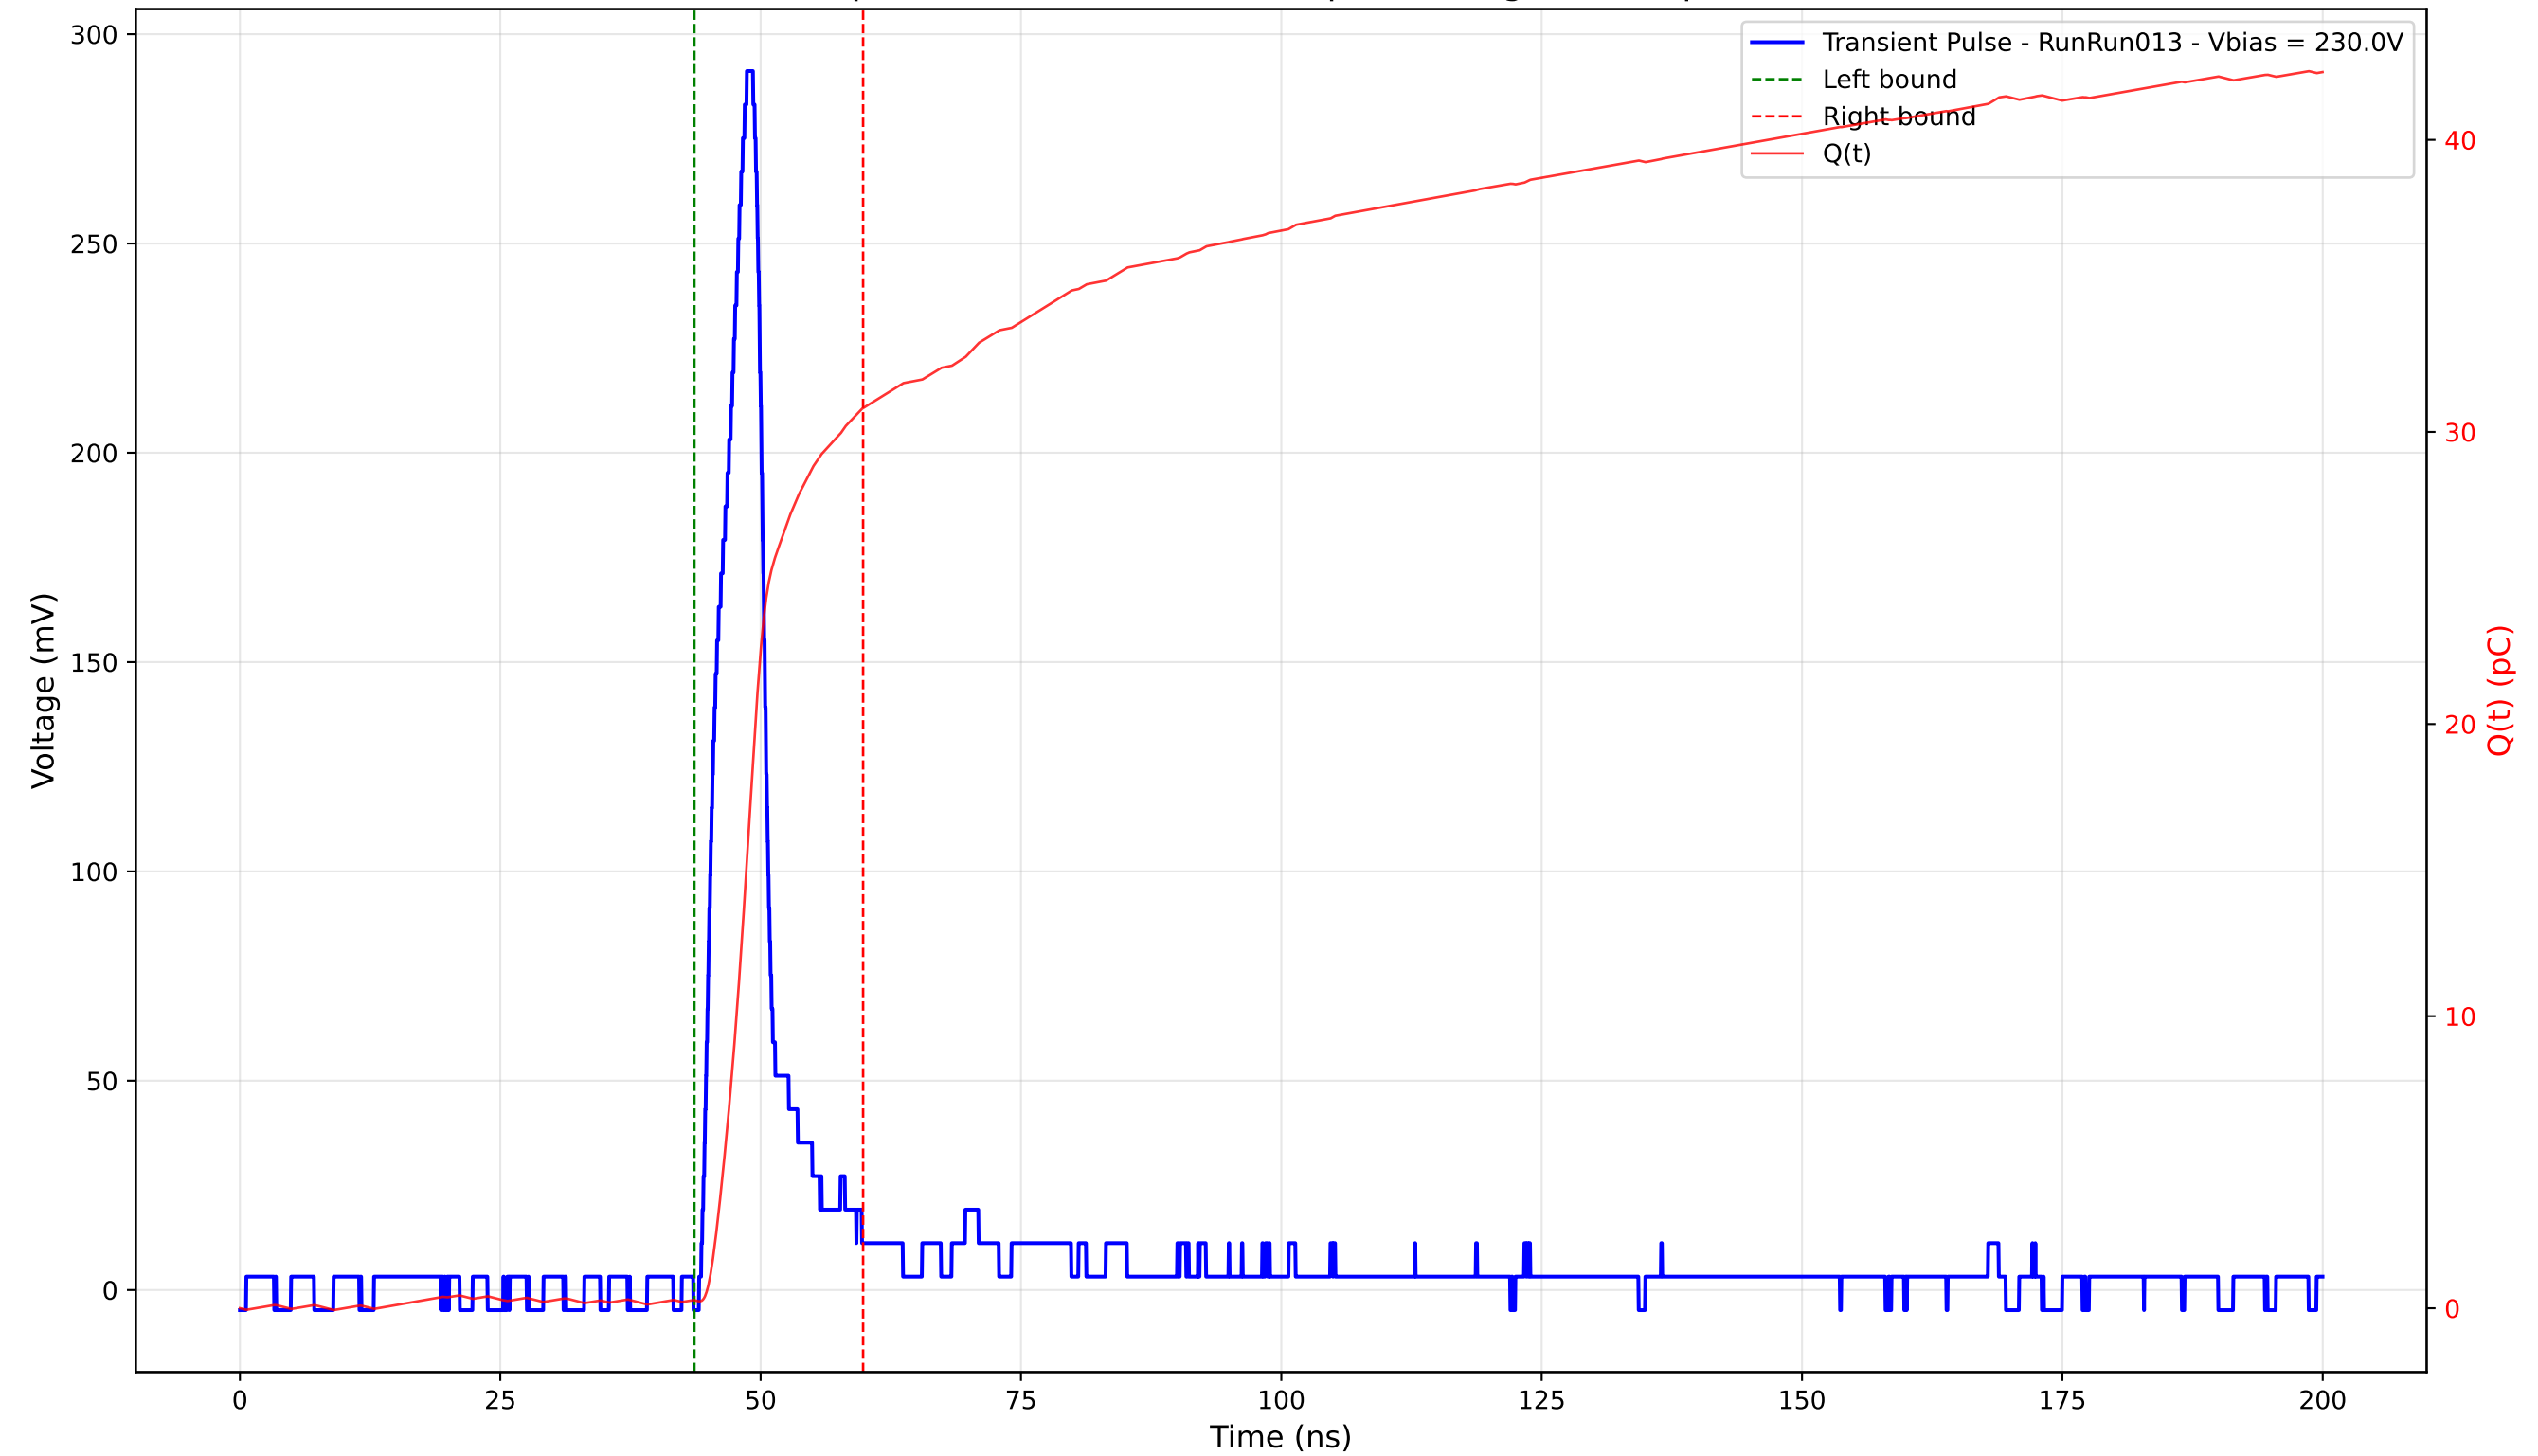


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 28.91 pC - Rise Time: 3.80 ns

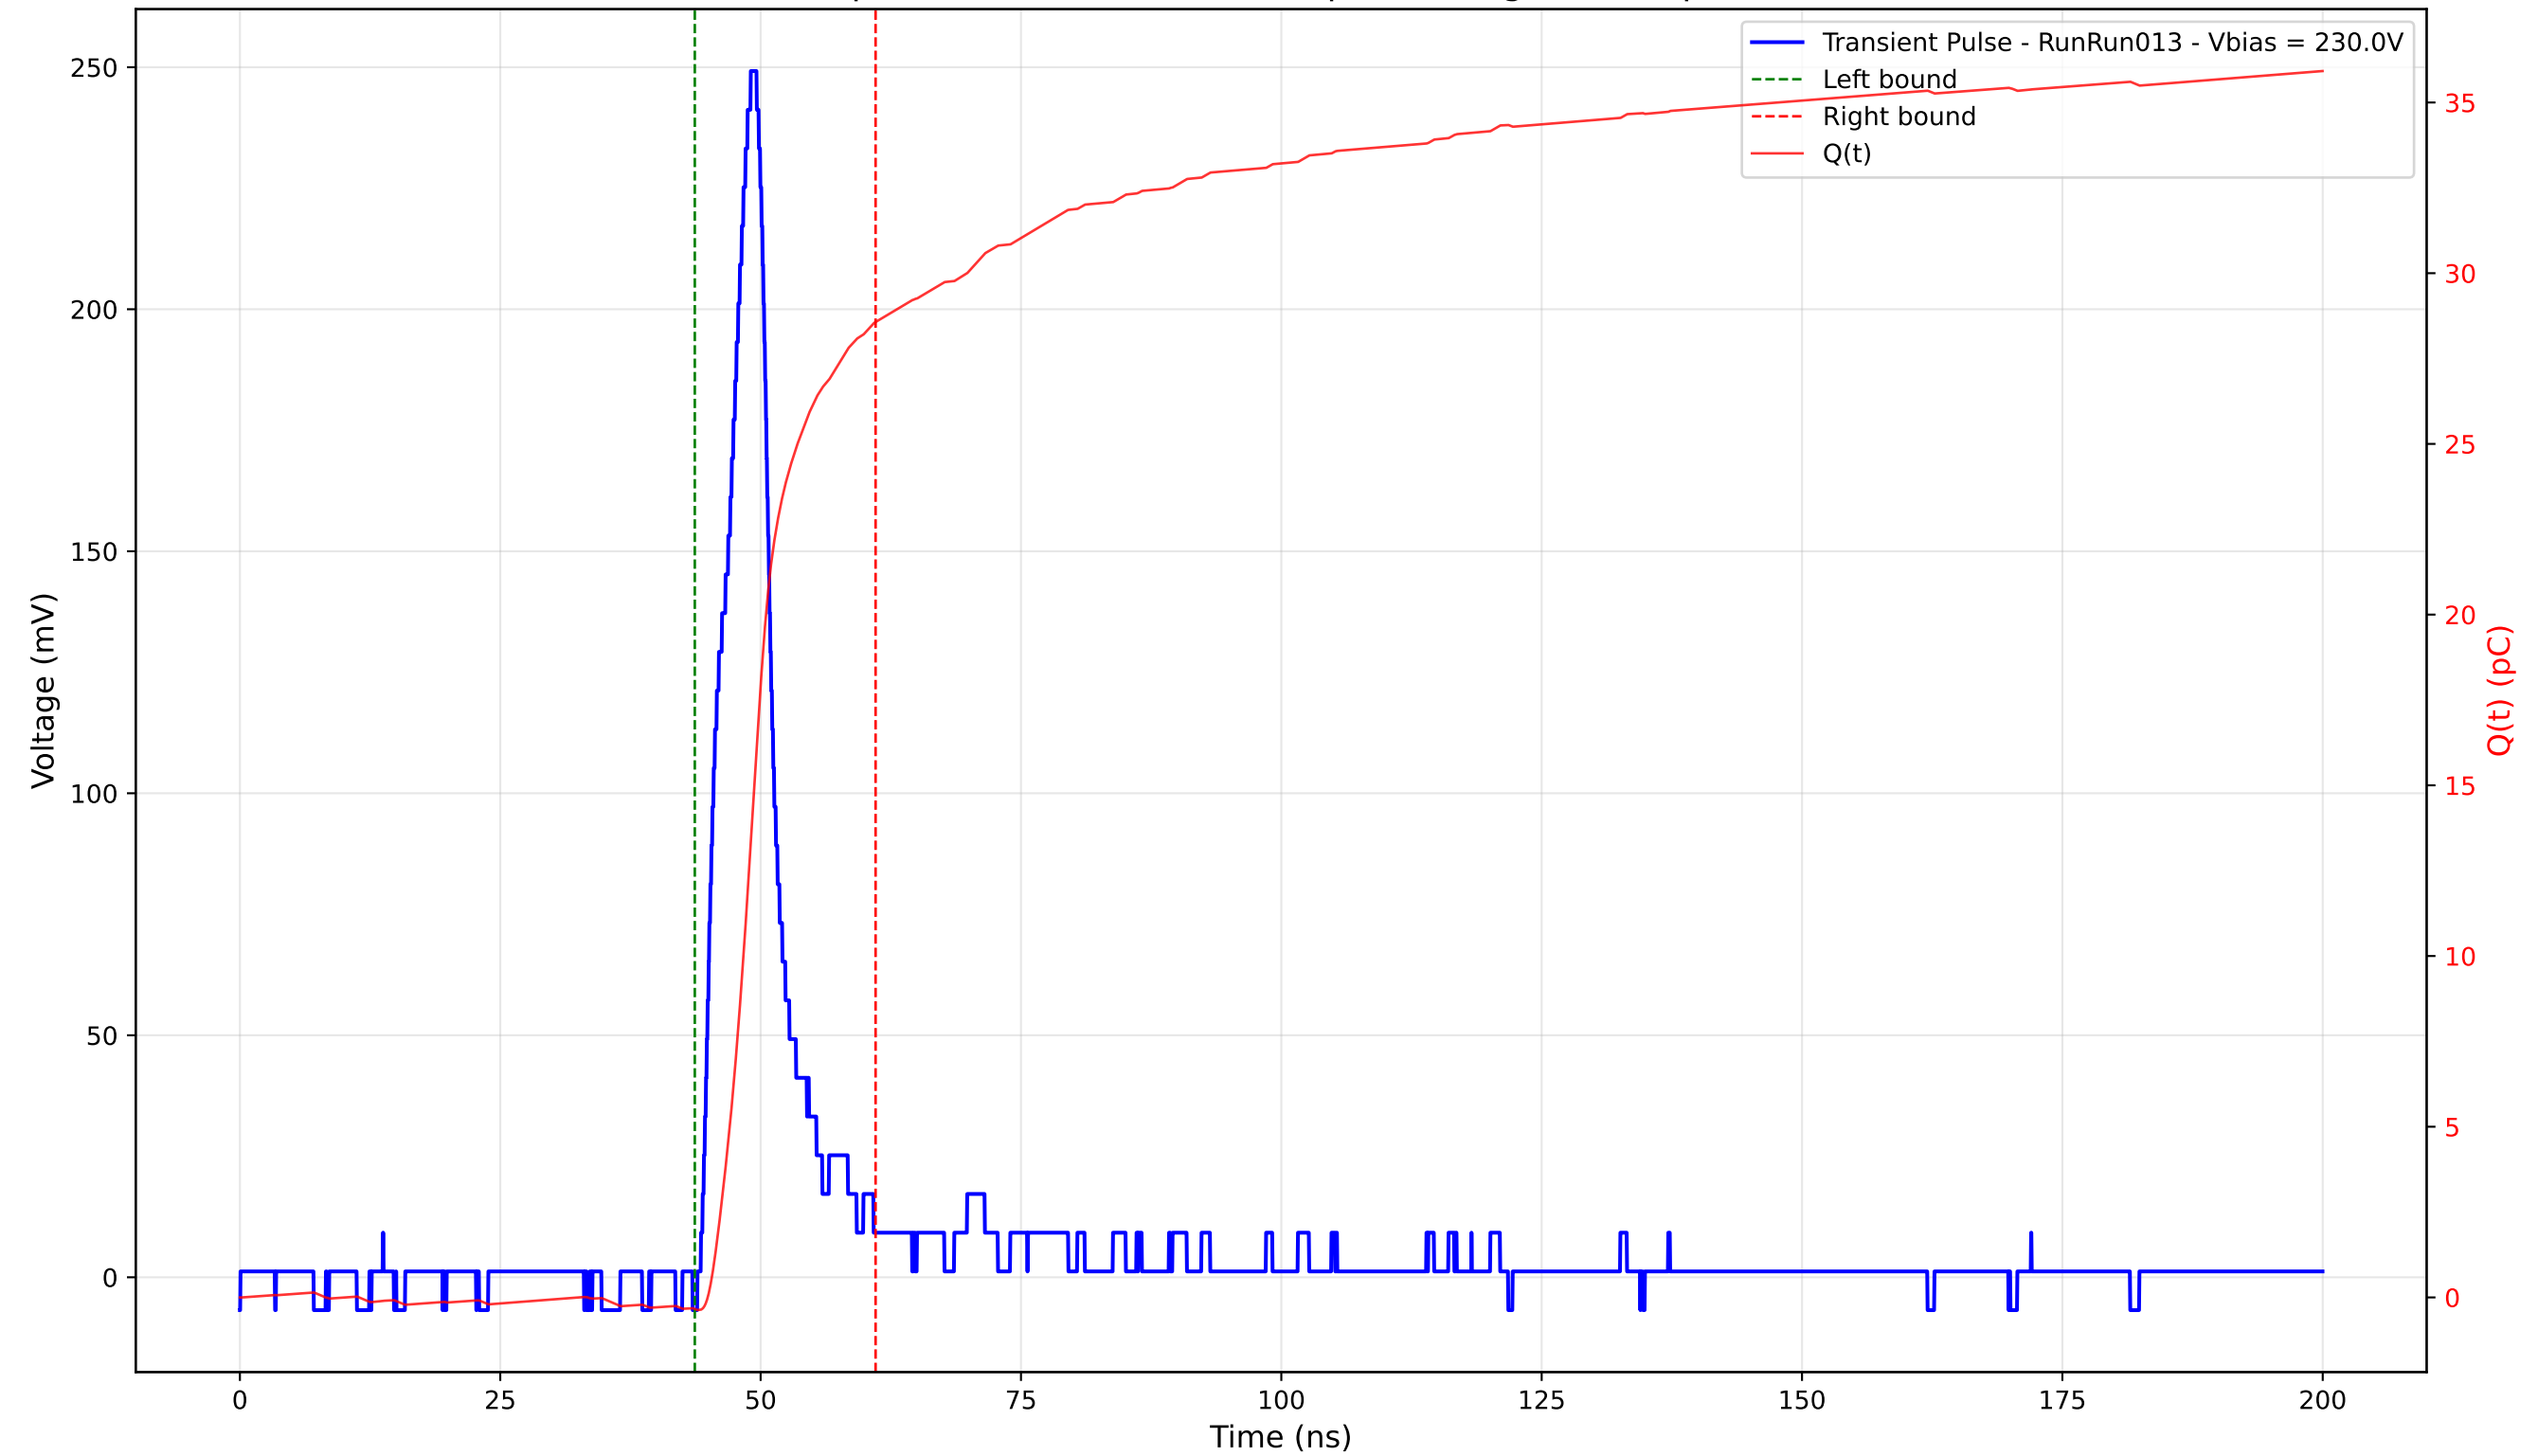


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 27.48 pC - Rise Time: 4.00 ns

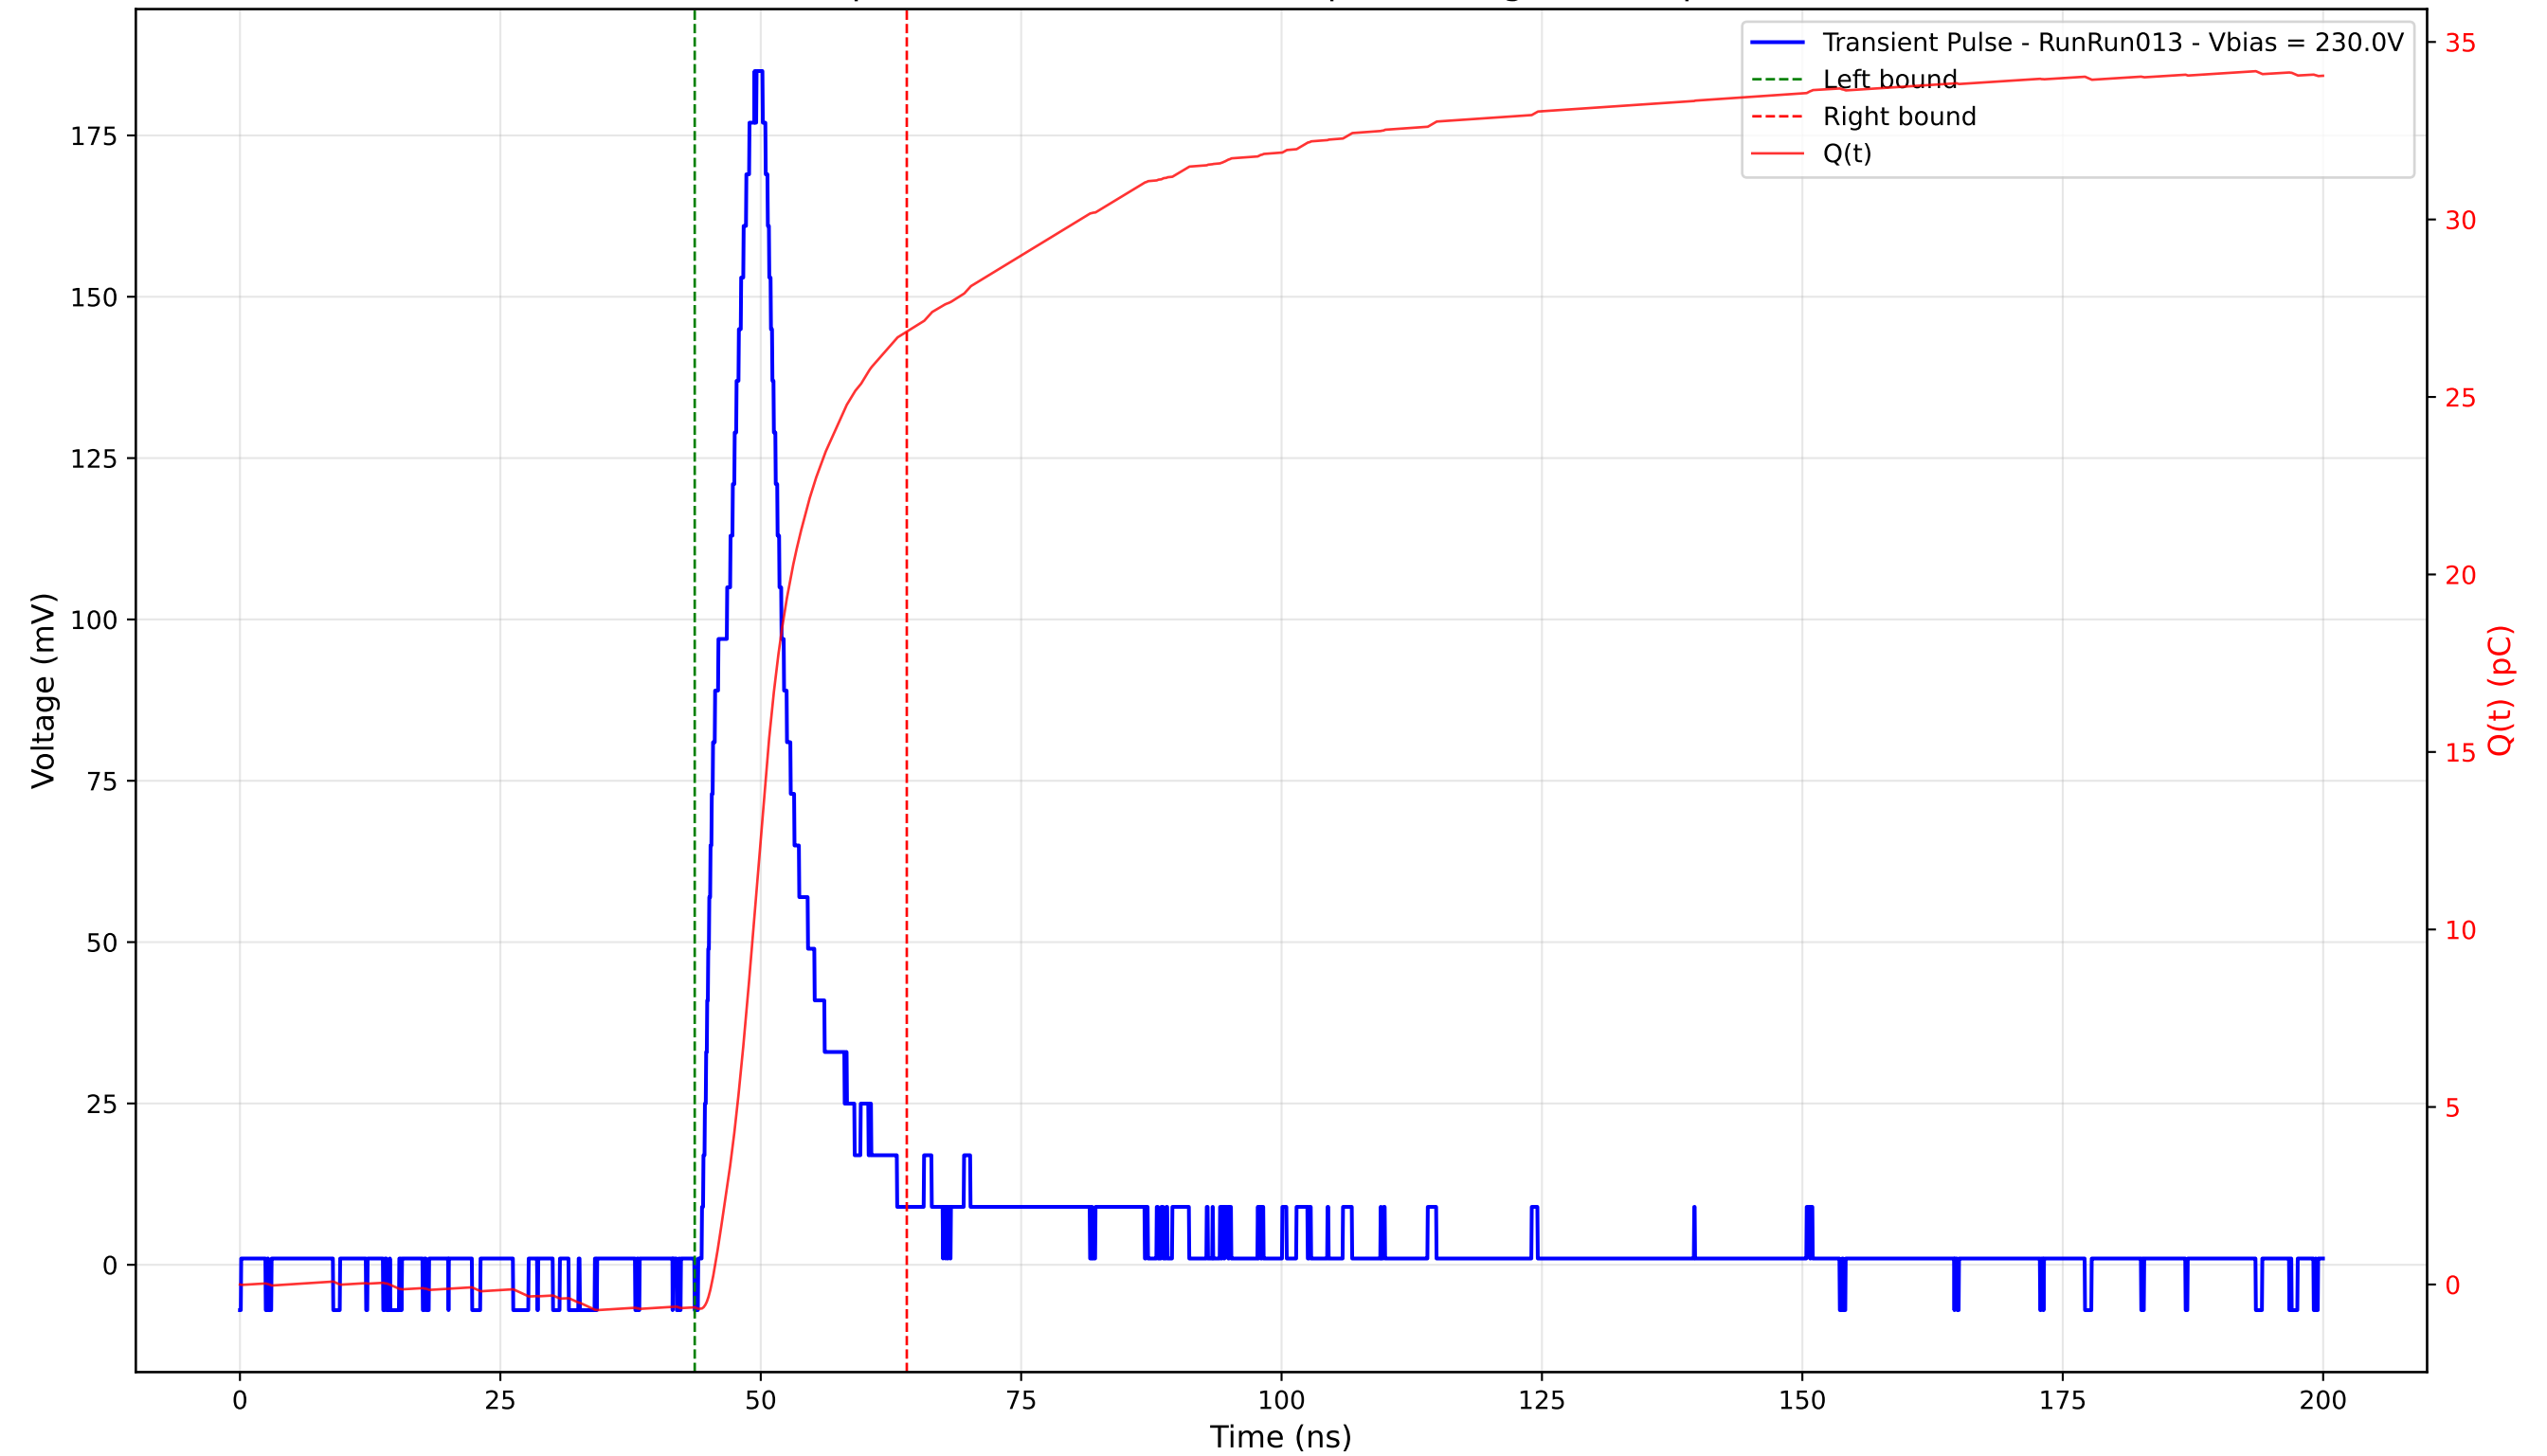


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 25.37 pC - Rise Time: 4.06 ns

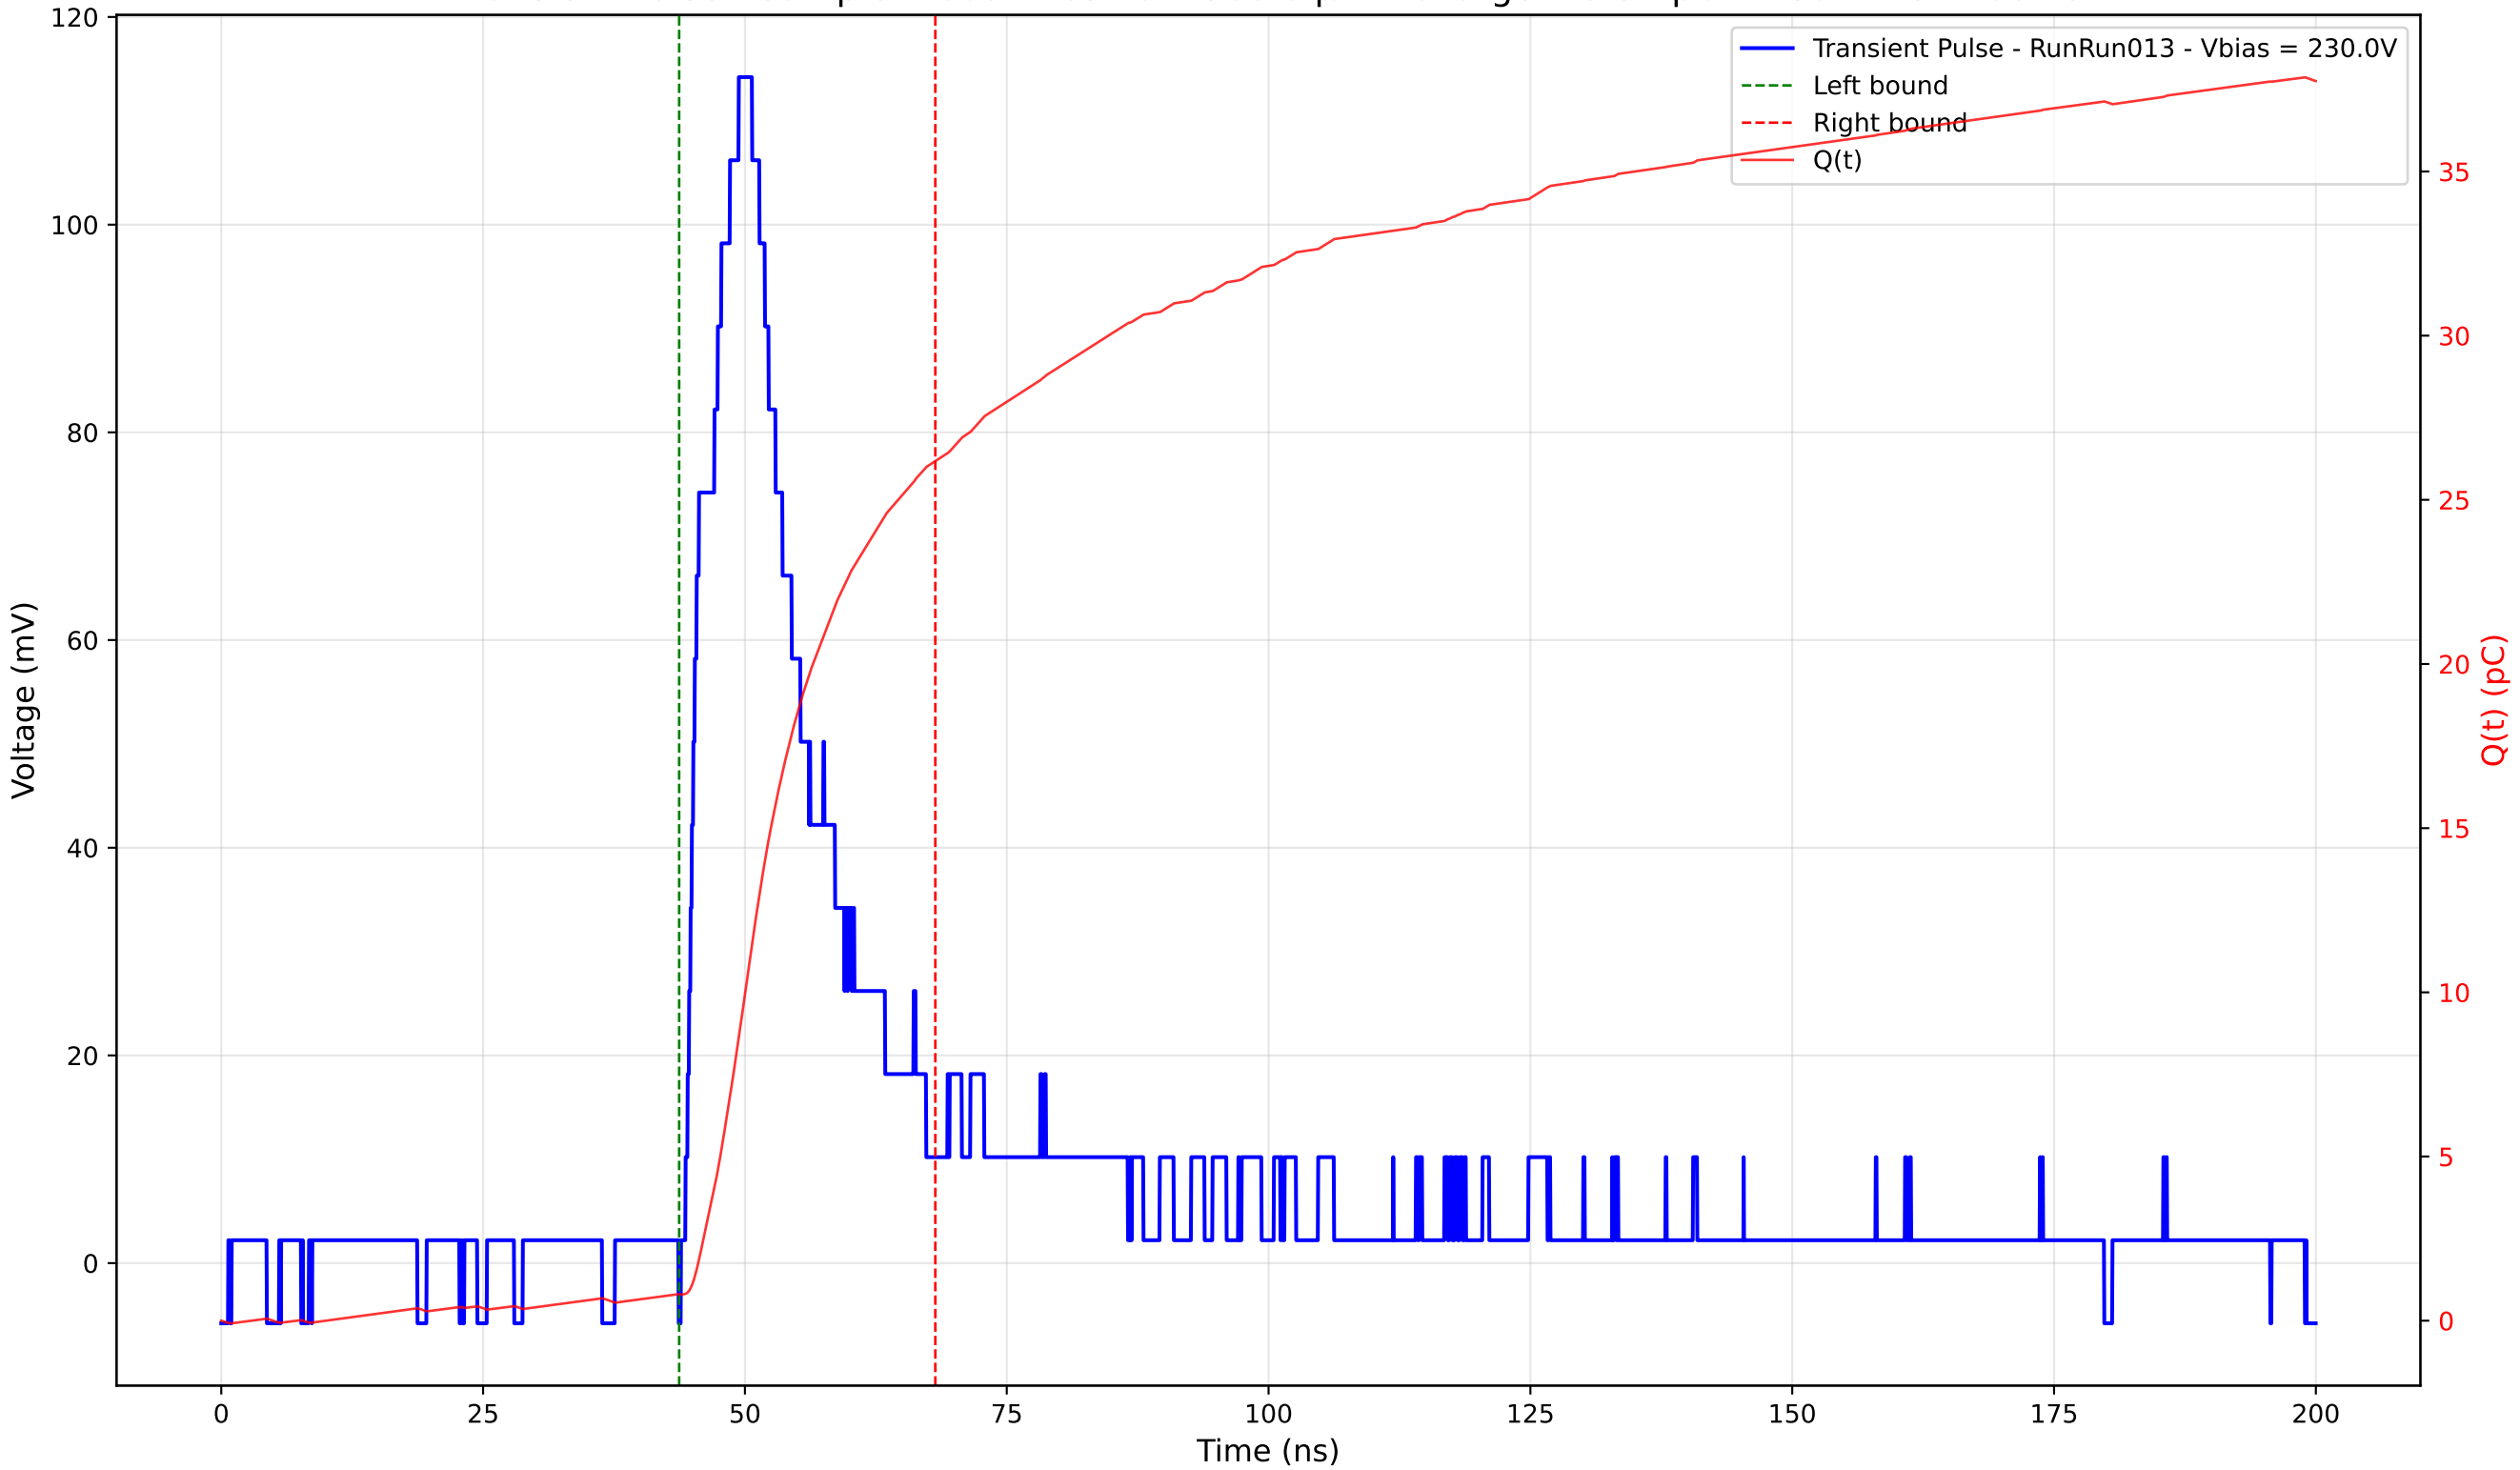


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 21.74 pC - Rise Time: 1.31 ns

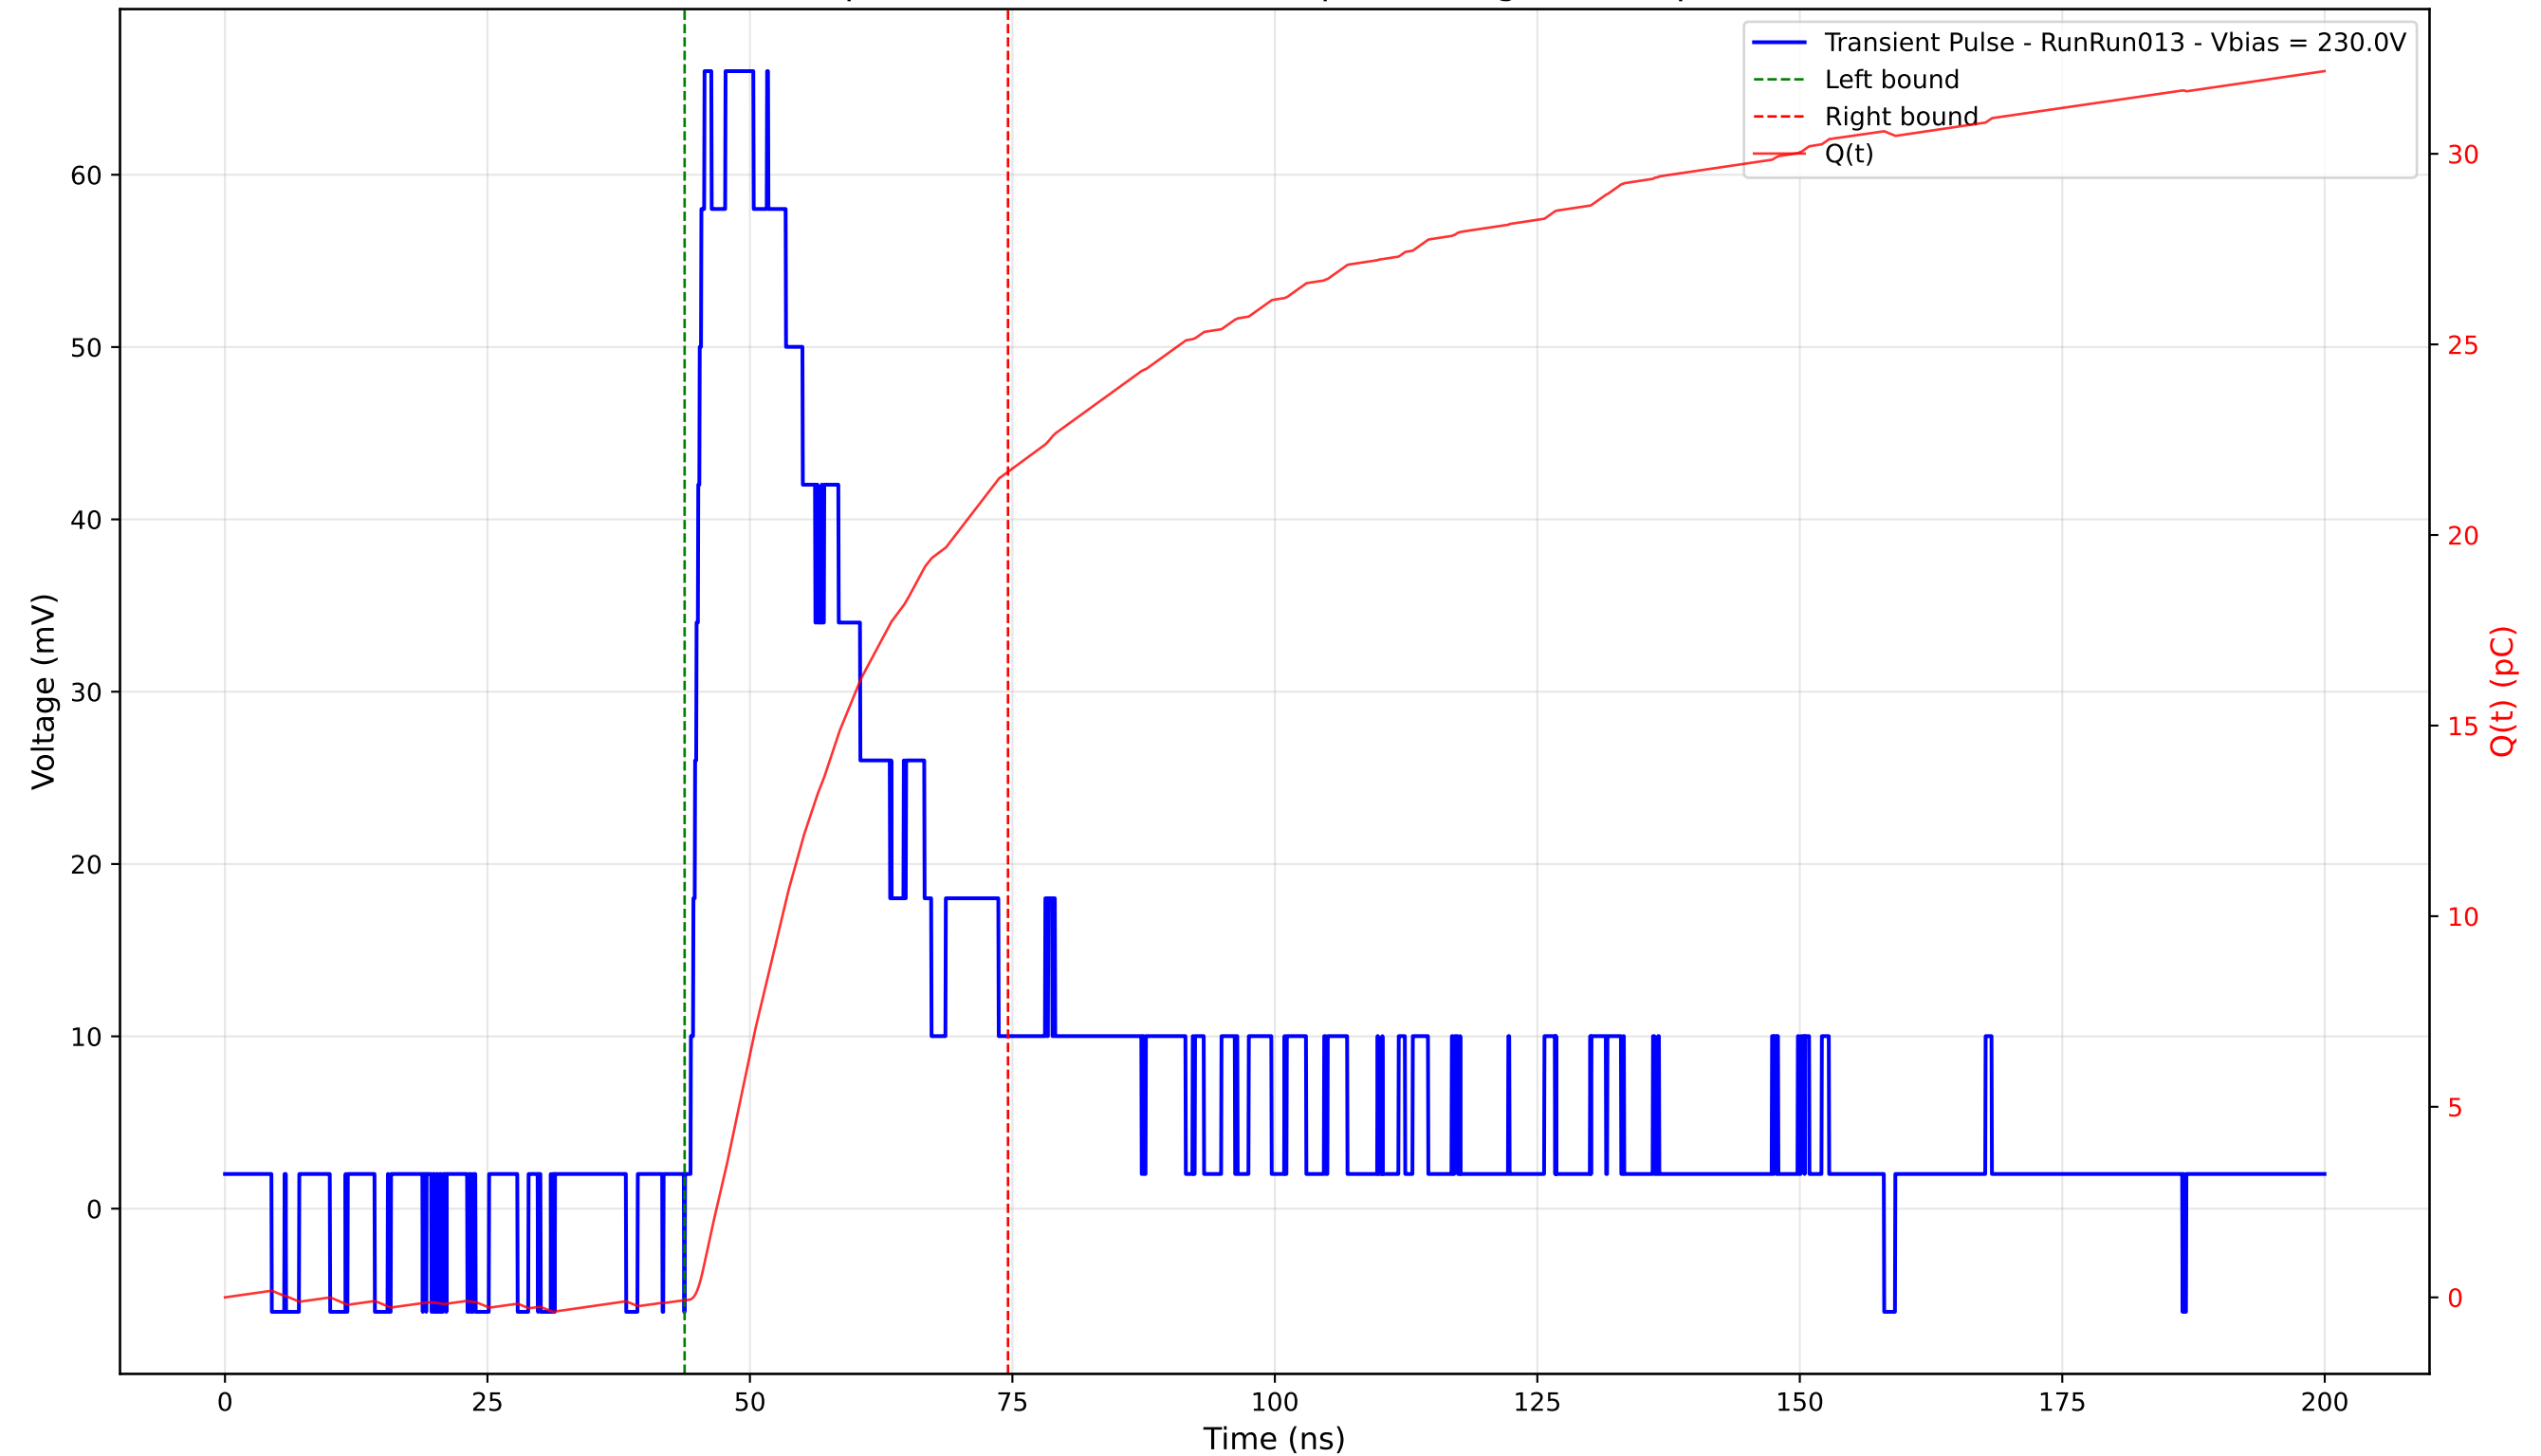


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 21.22 pC - Rise Time: 1.03 ns

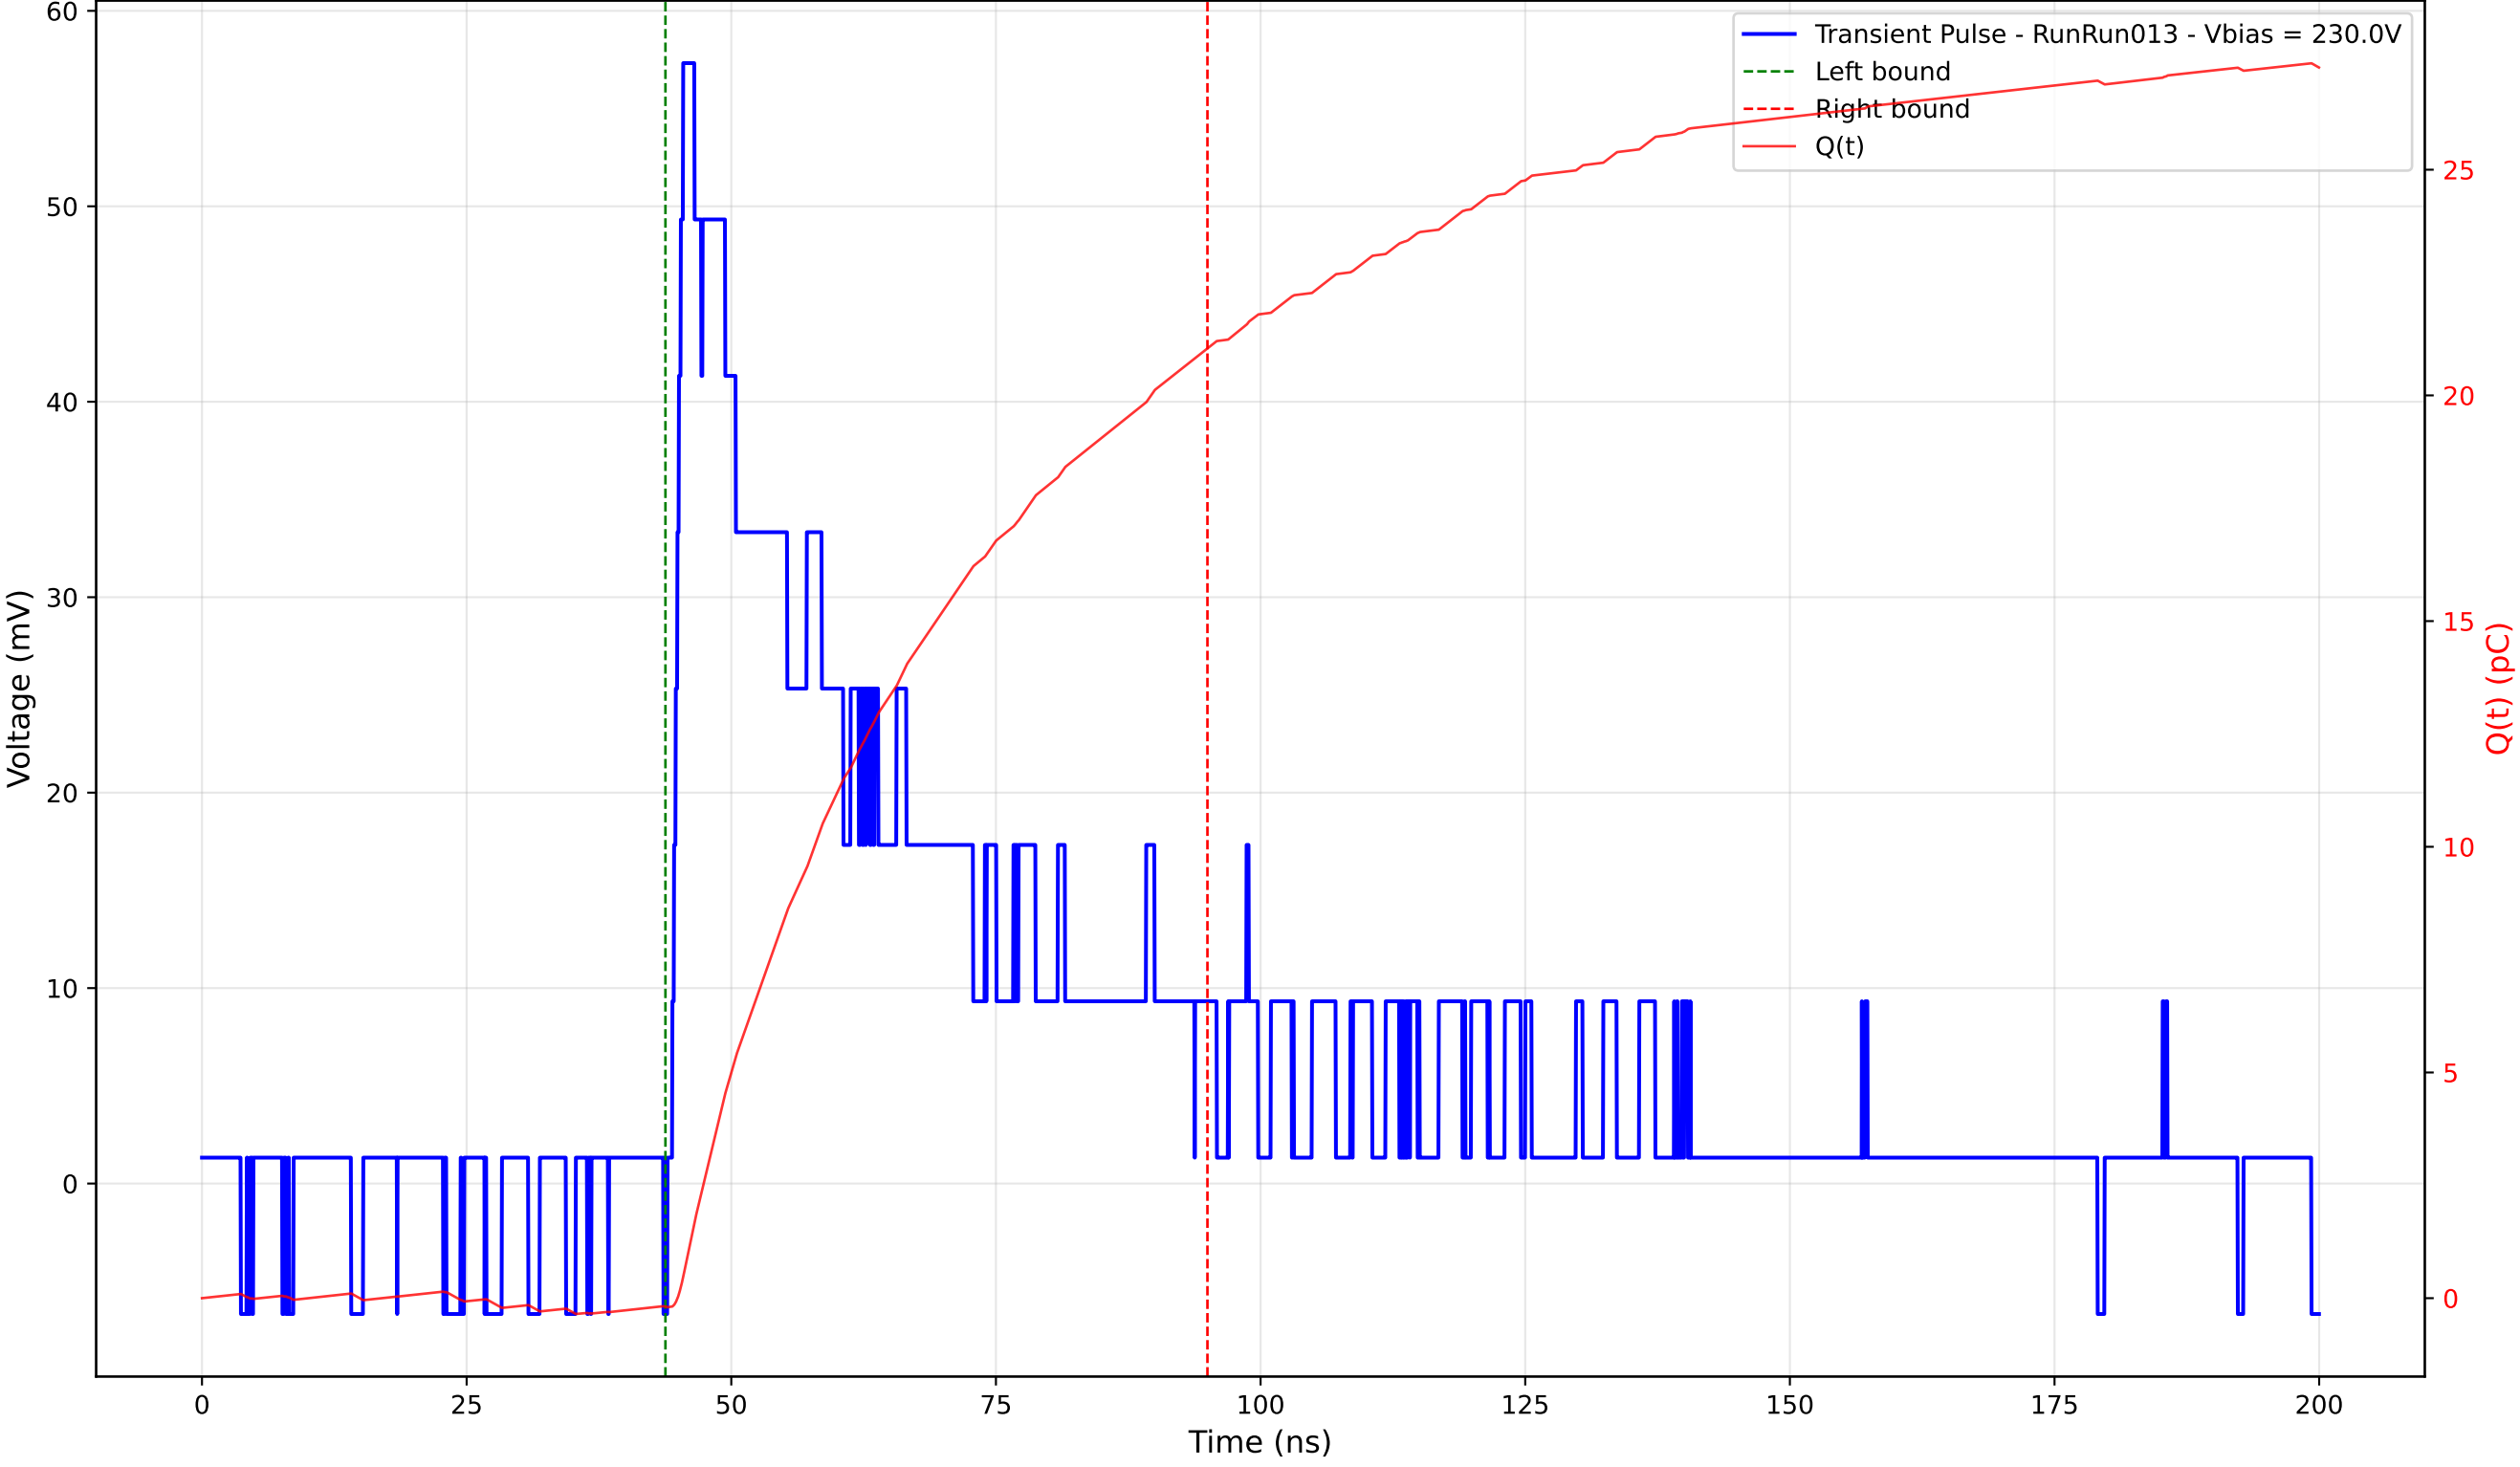


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 15.36 pC - Rise Time: 0.99 ns

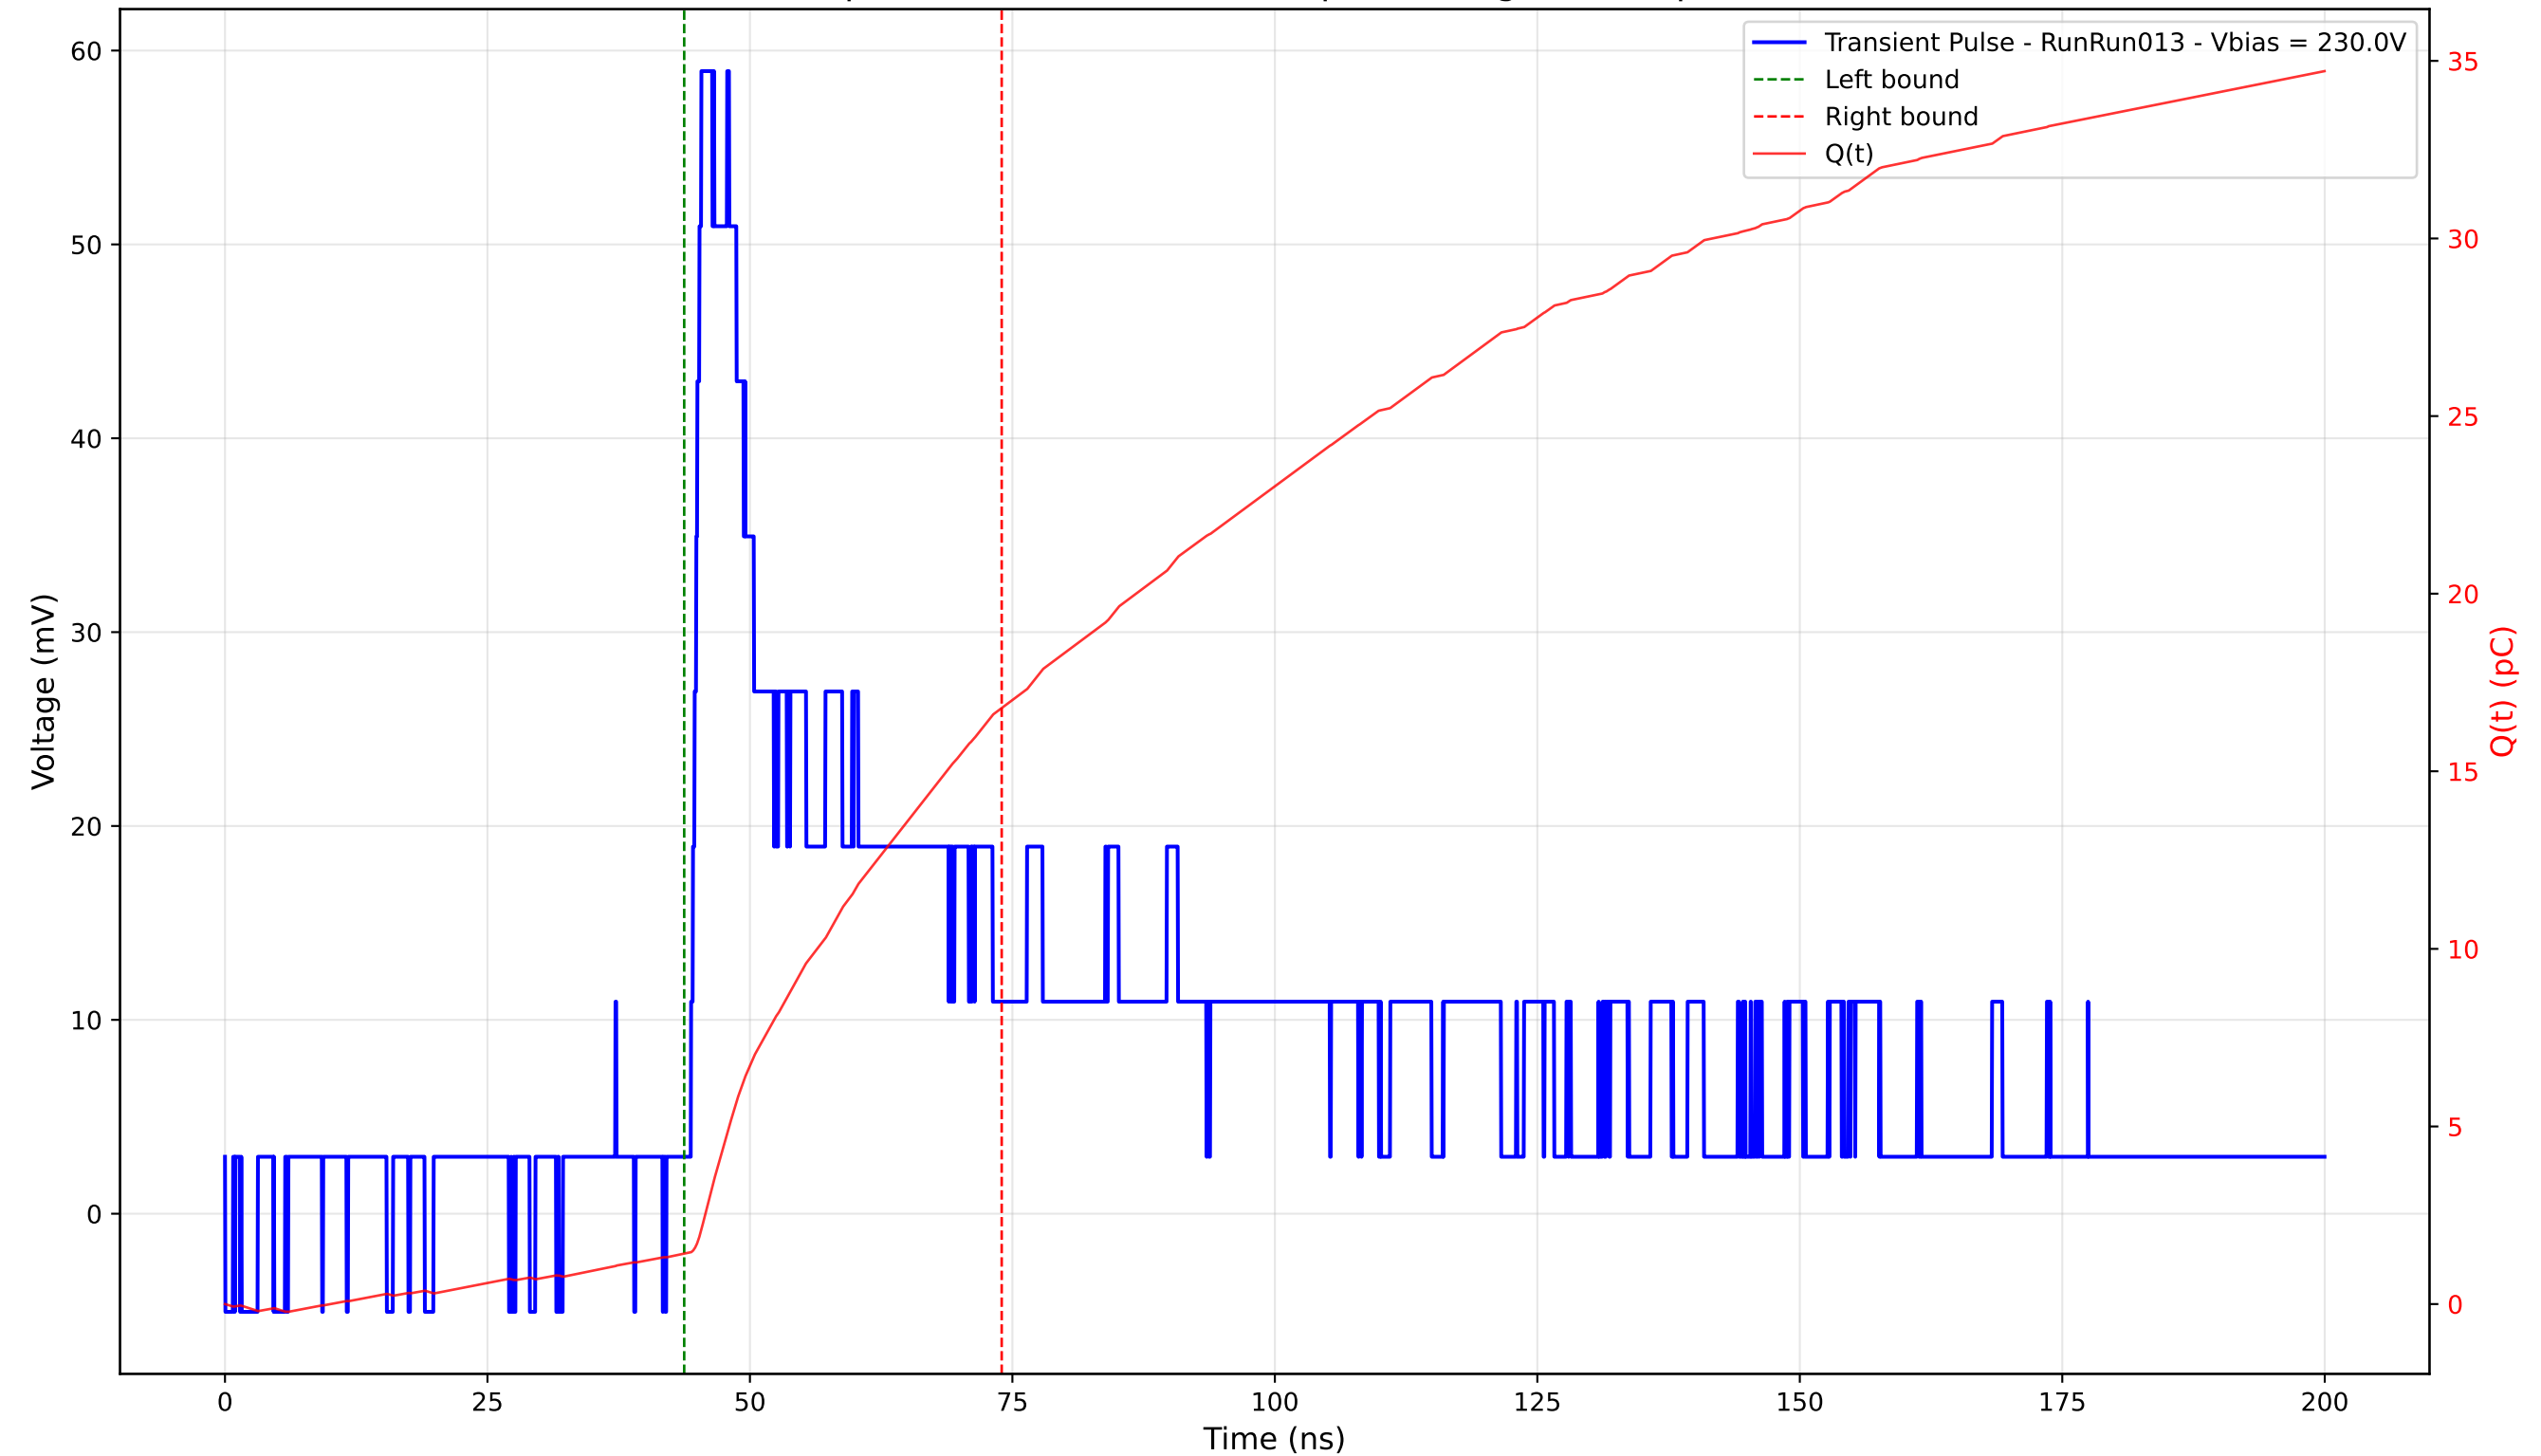


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 9.18 pC - Rise Time: 1.29 ns

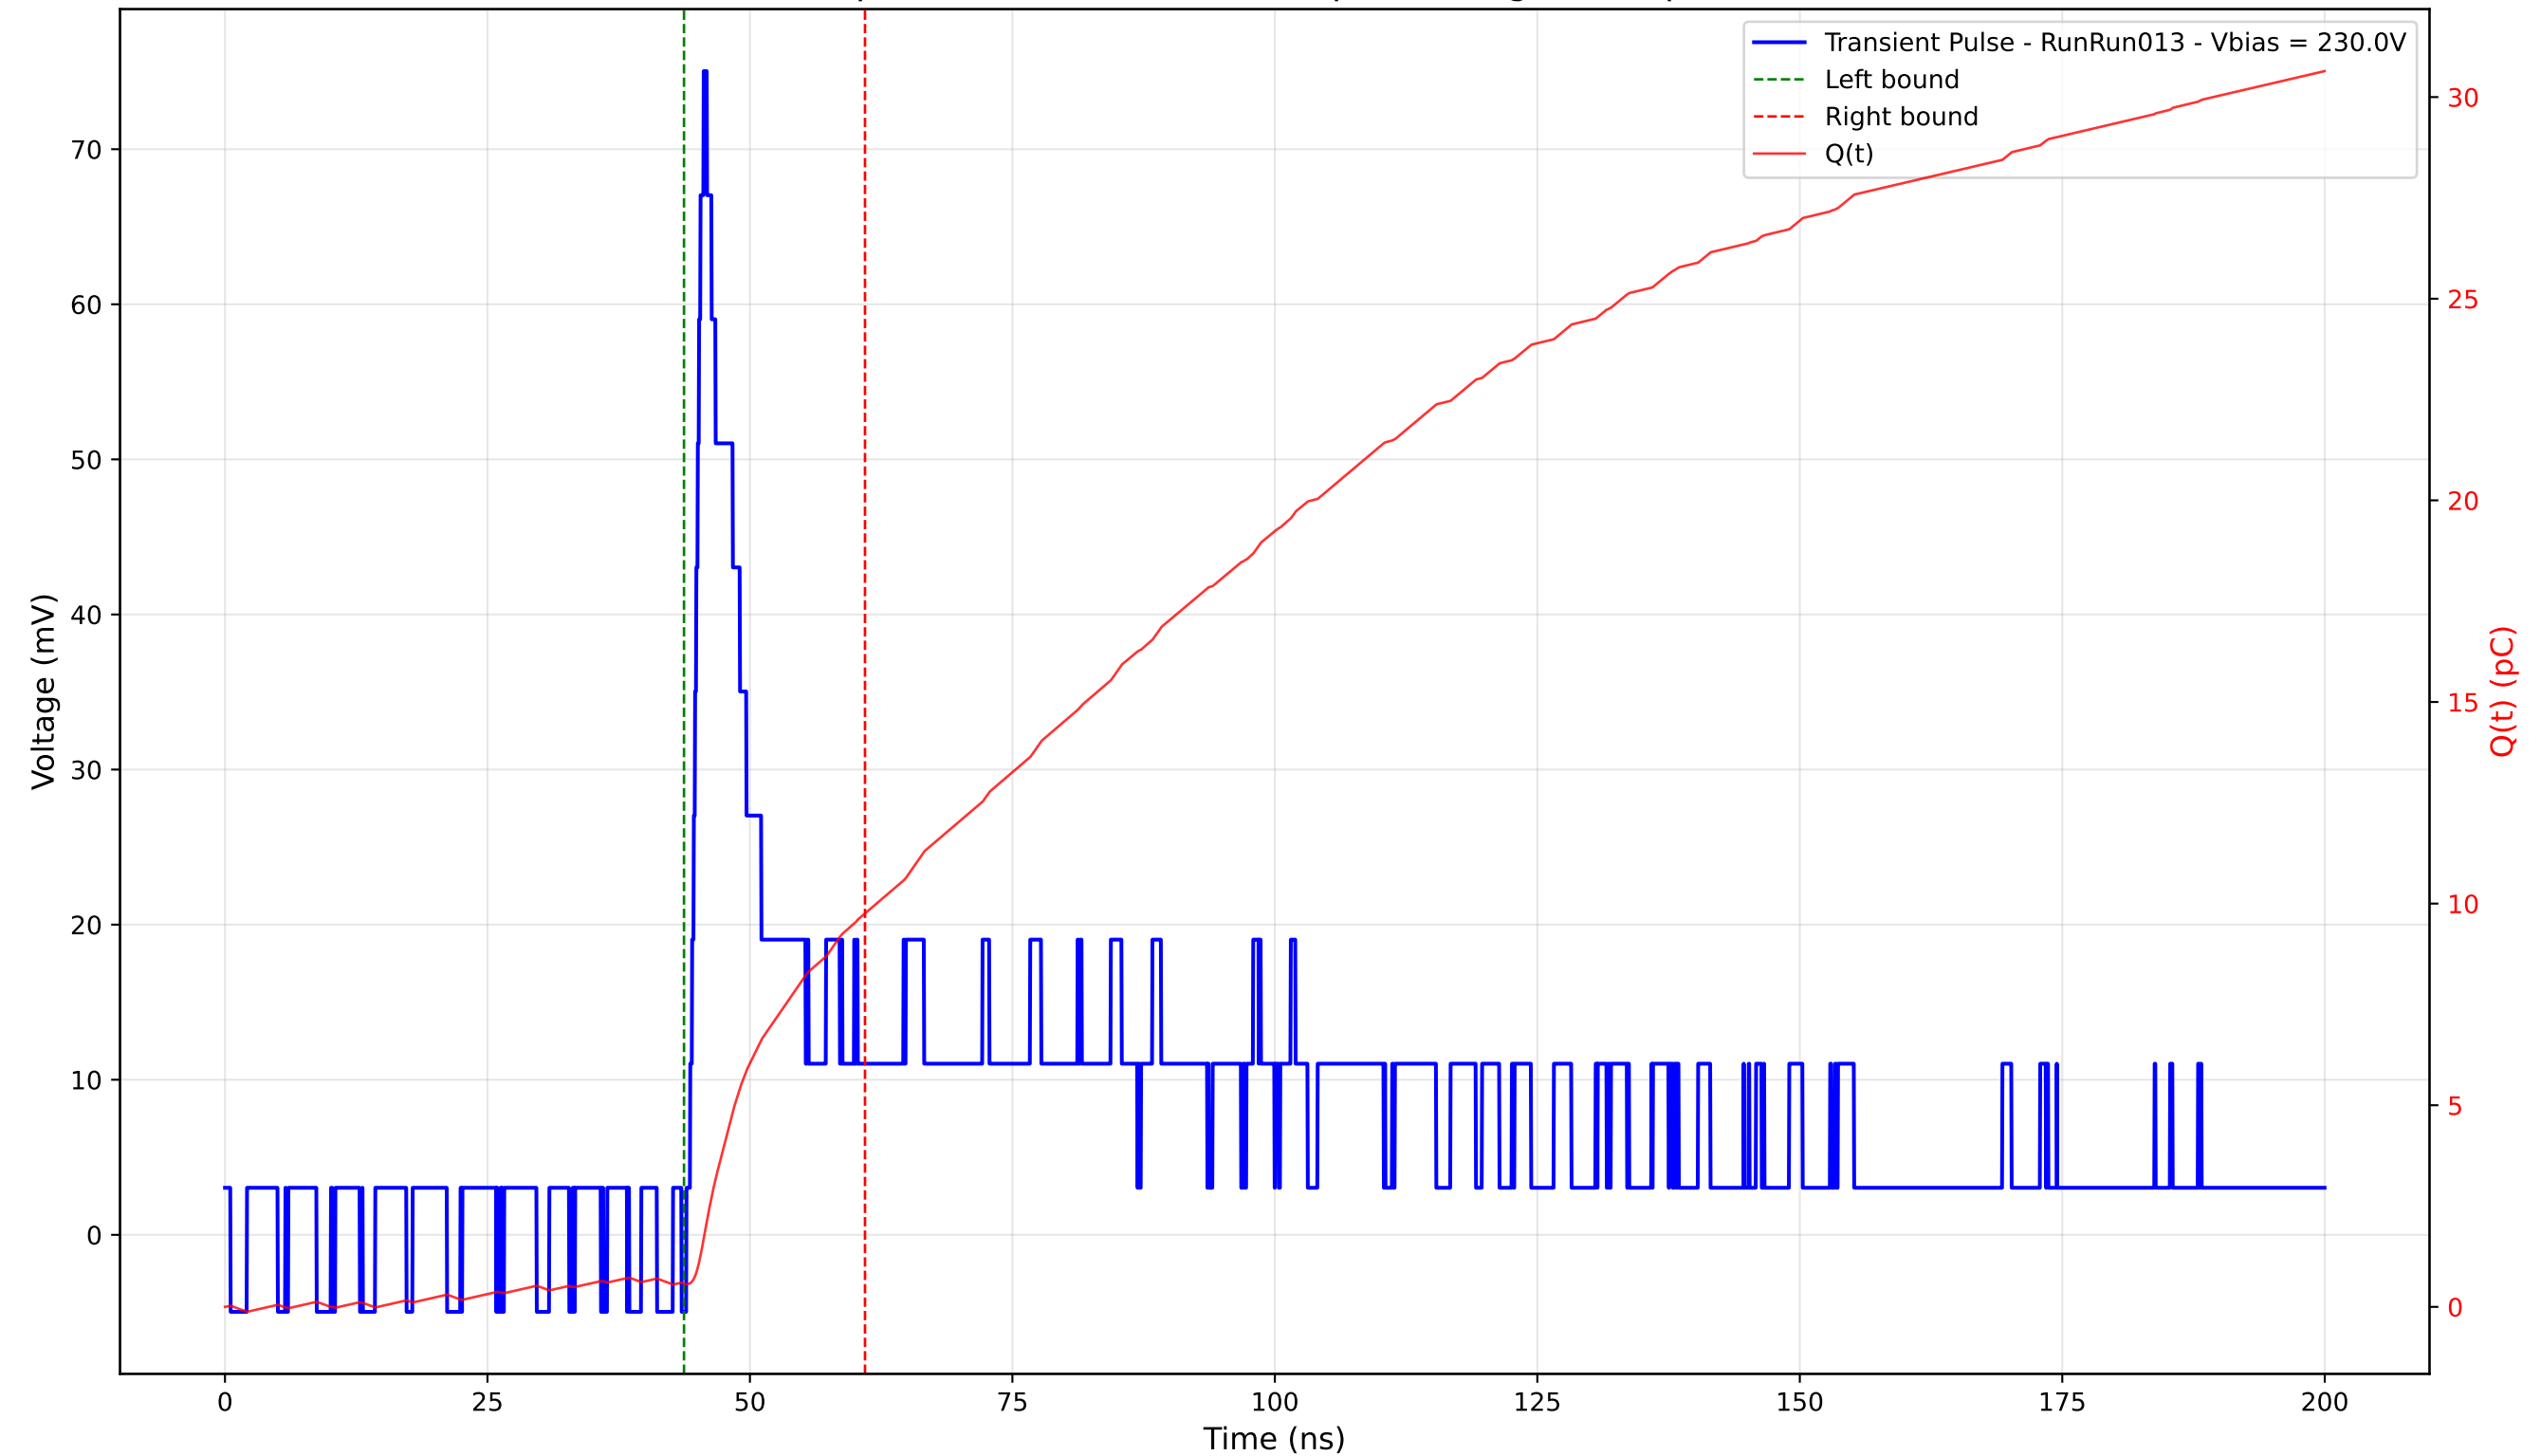


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 8.79 pC - Rise Time: 0.96 ns

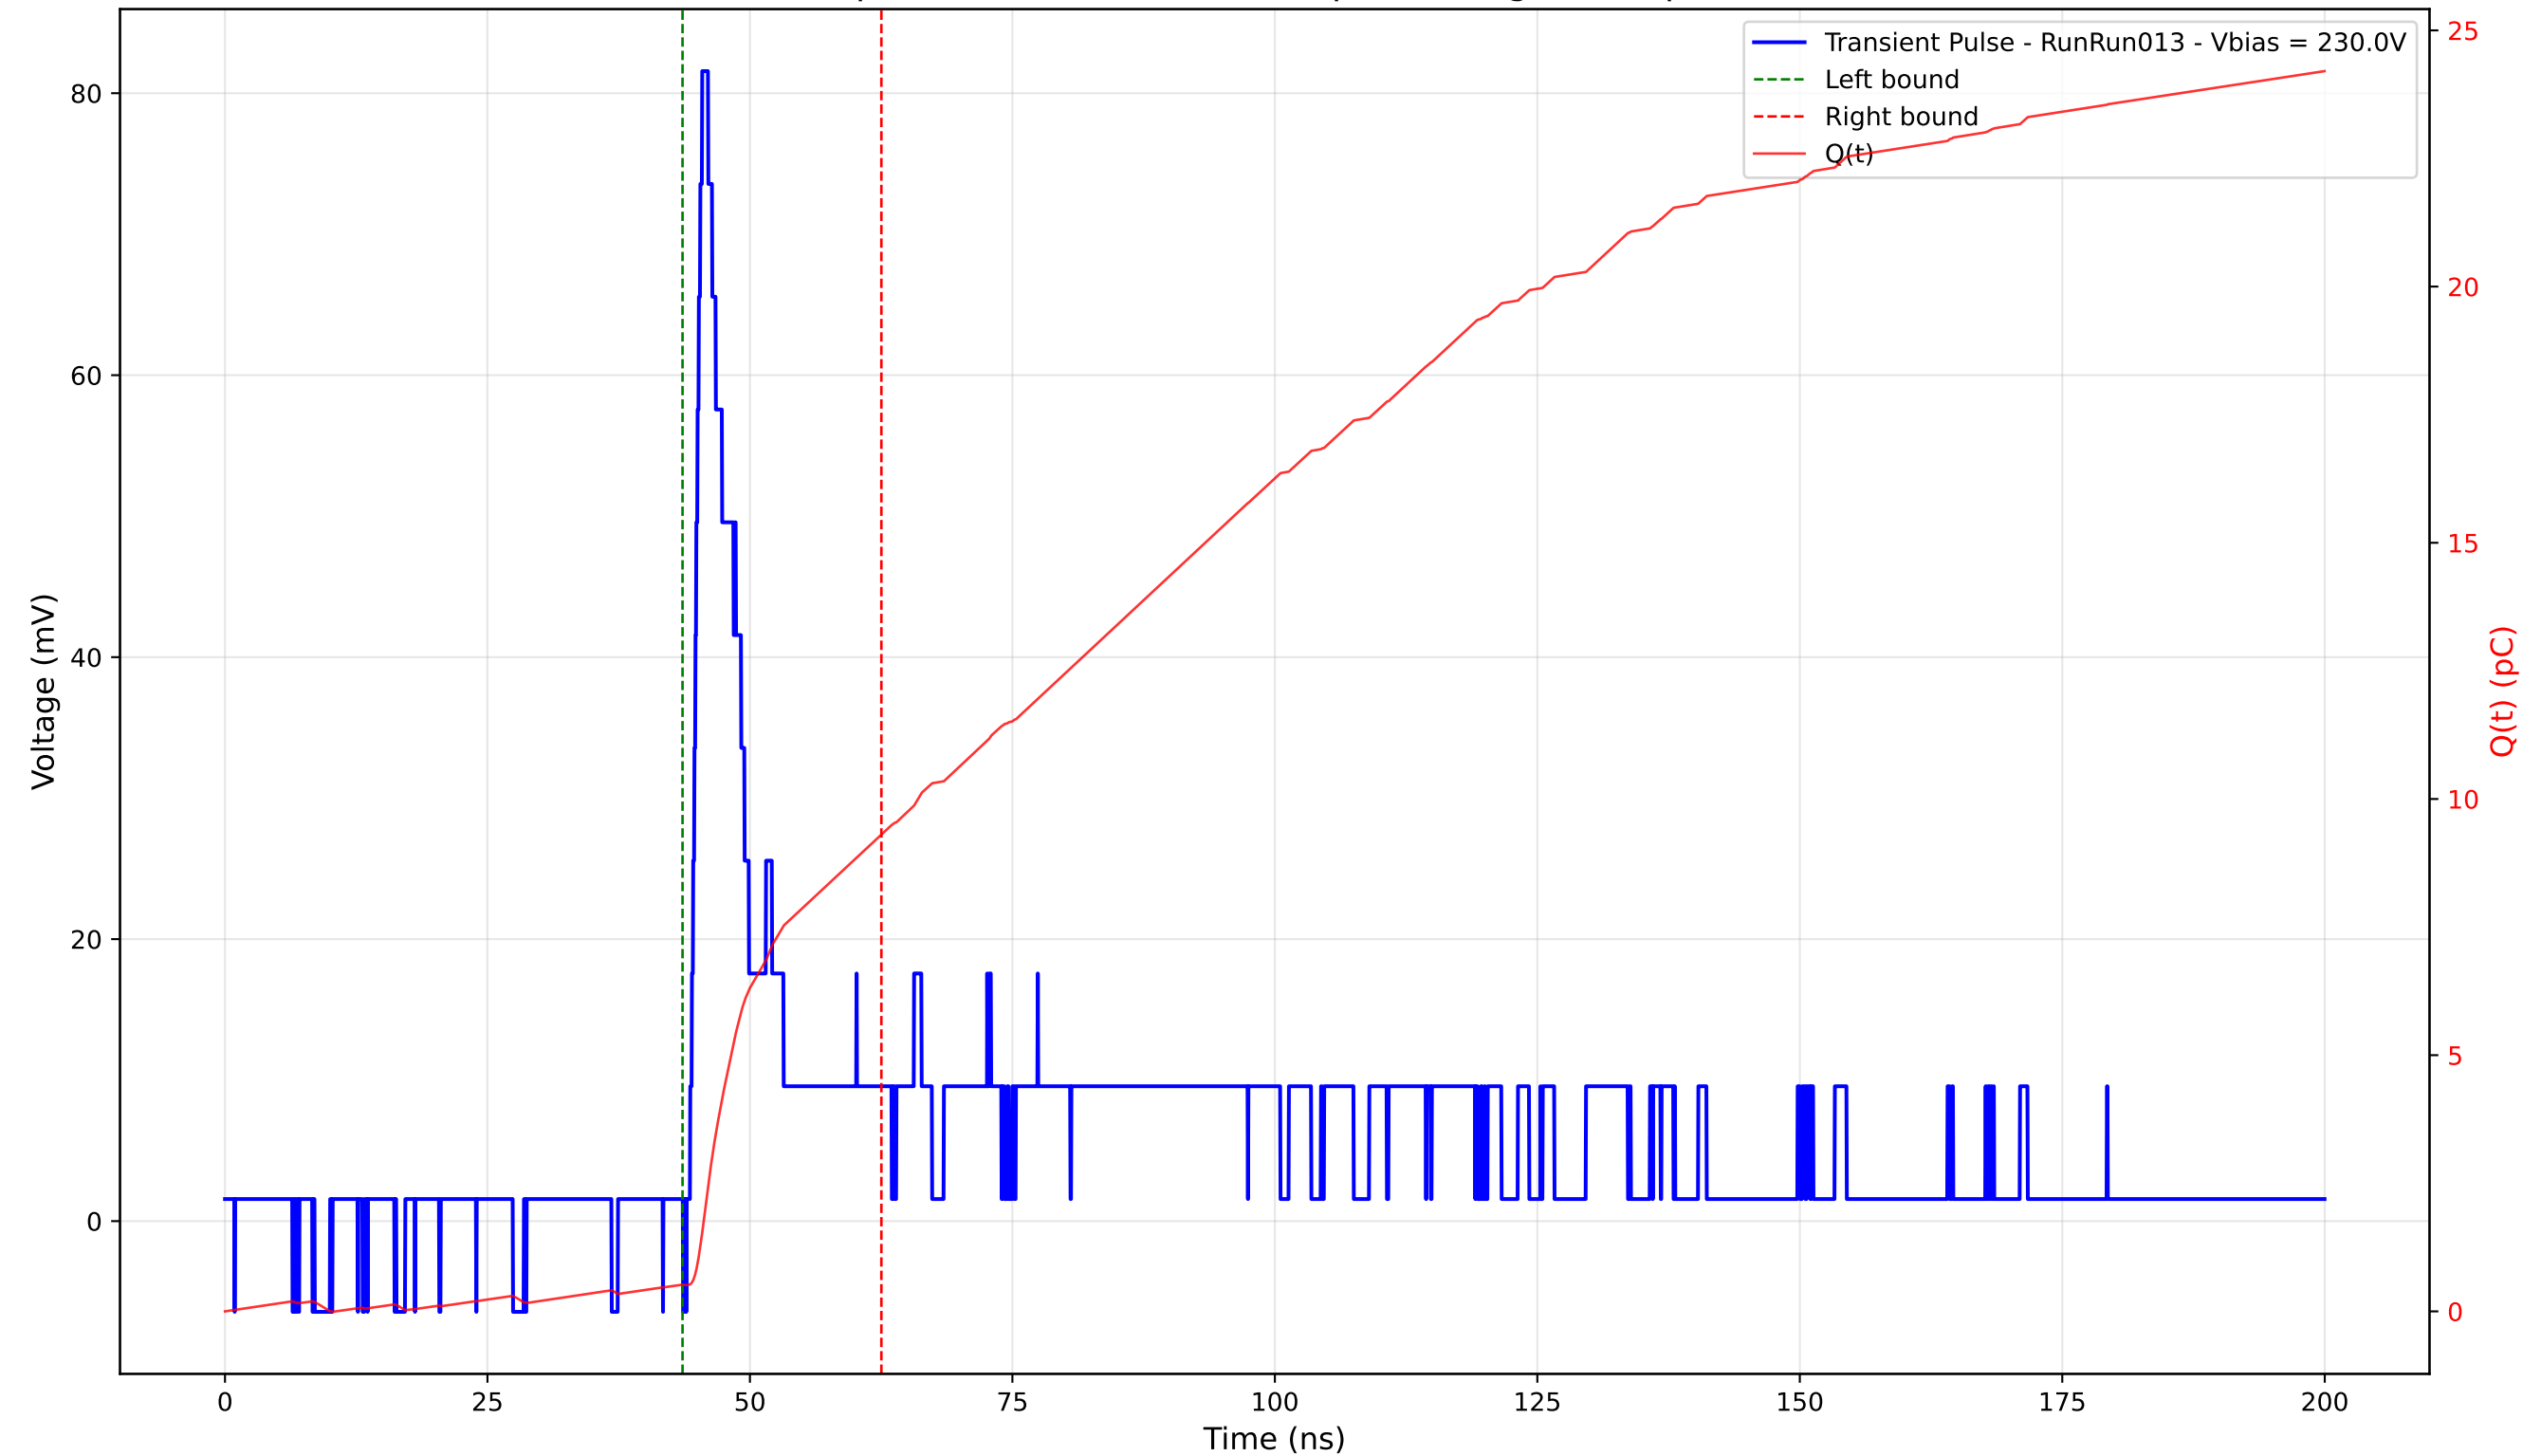


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 6.33 pC - Rise Time: 1.09 ns

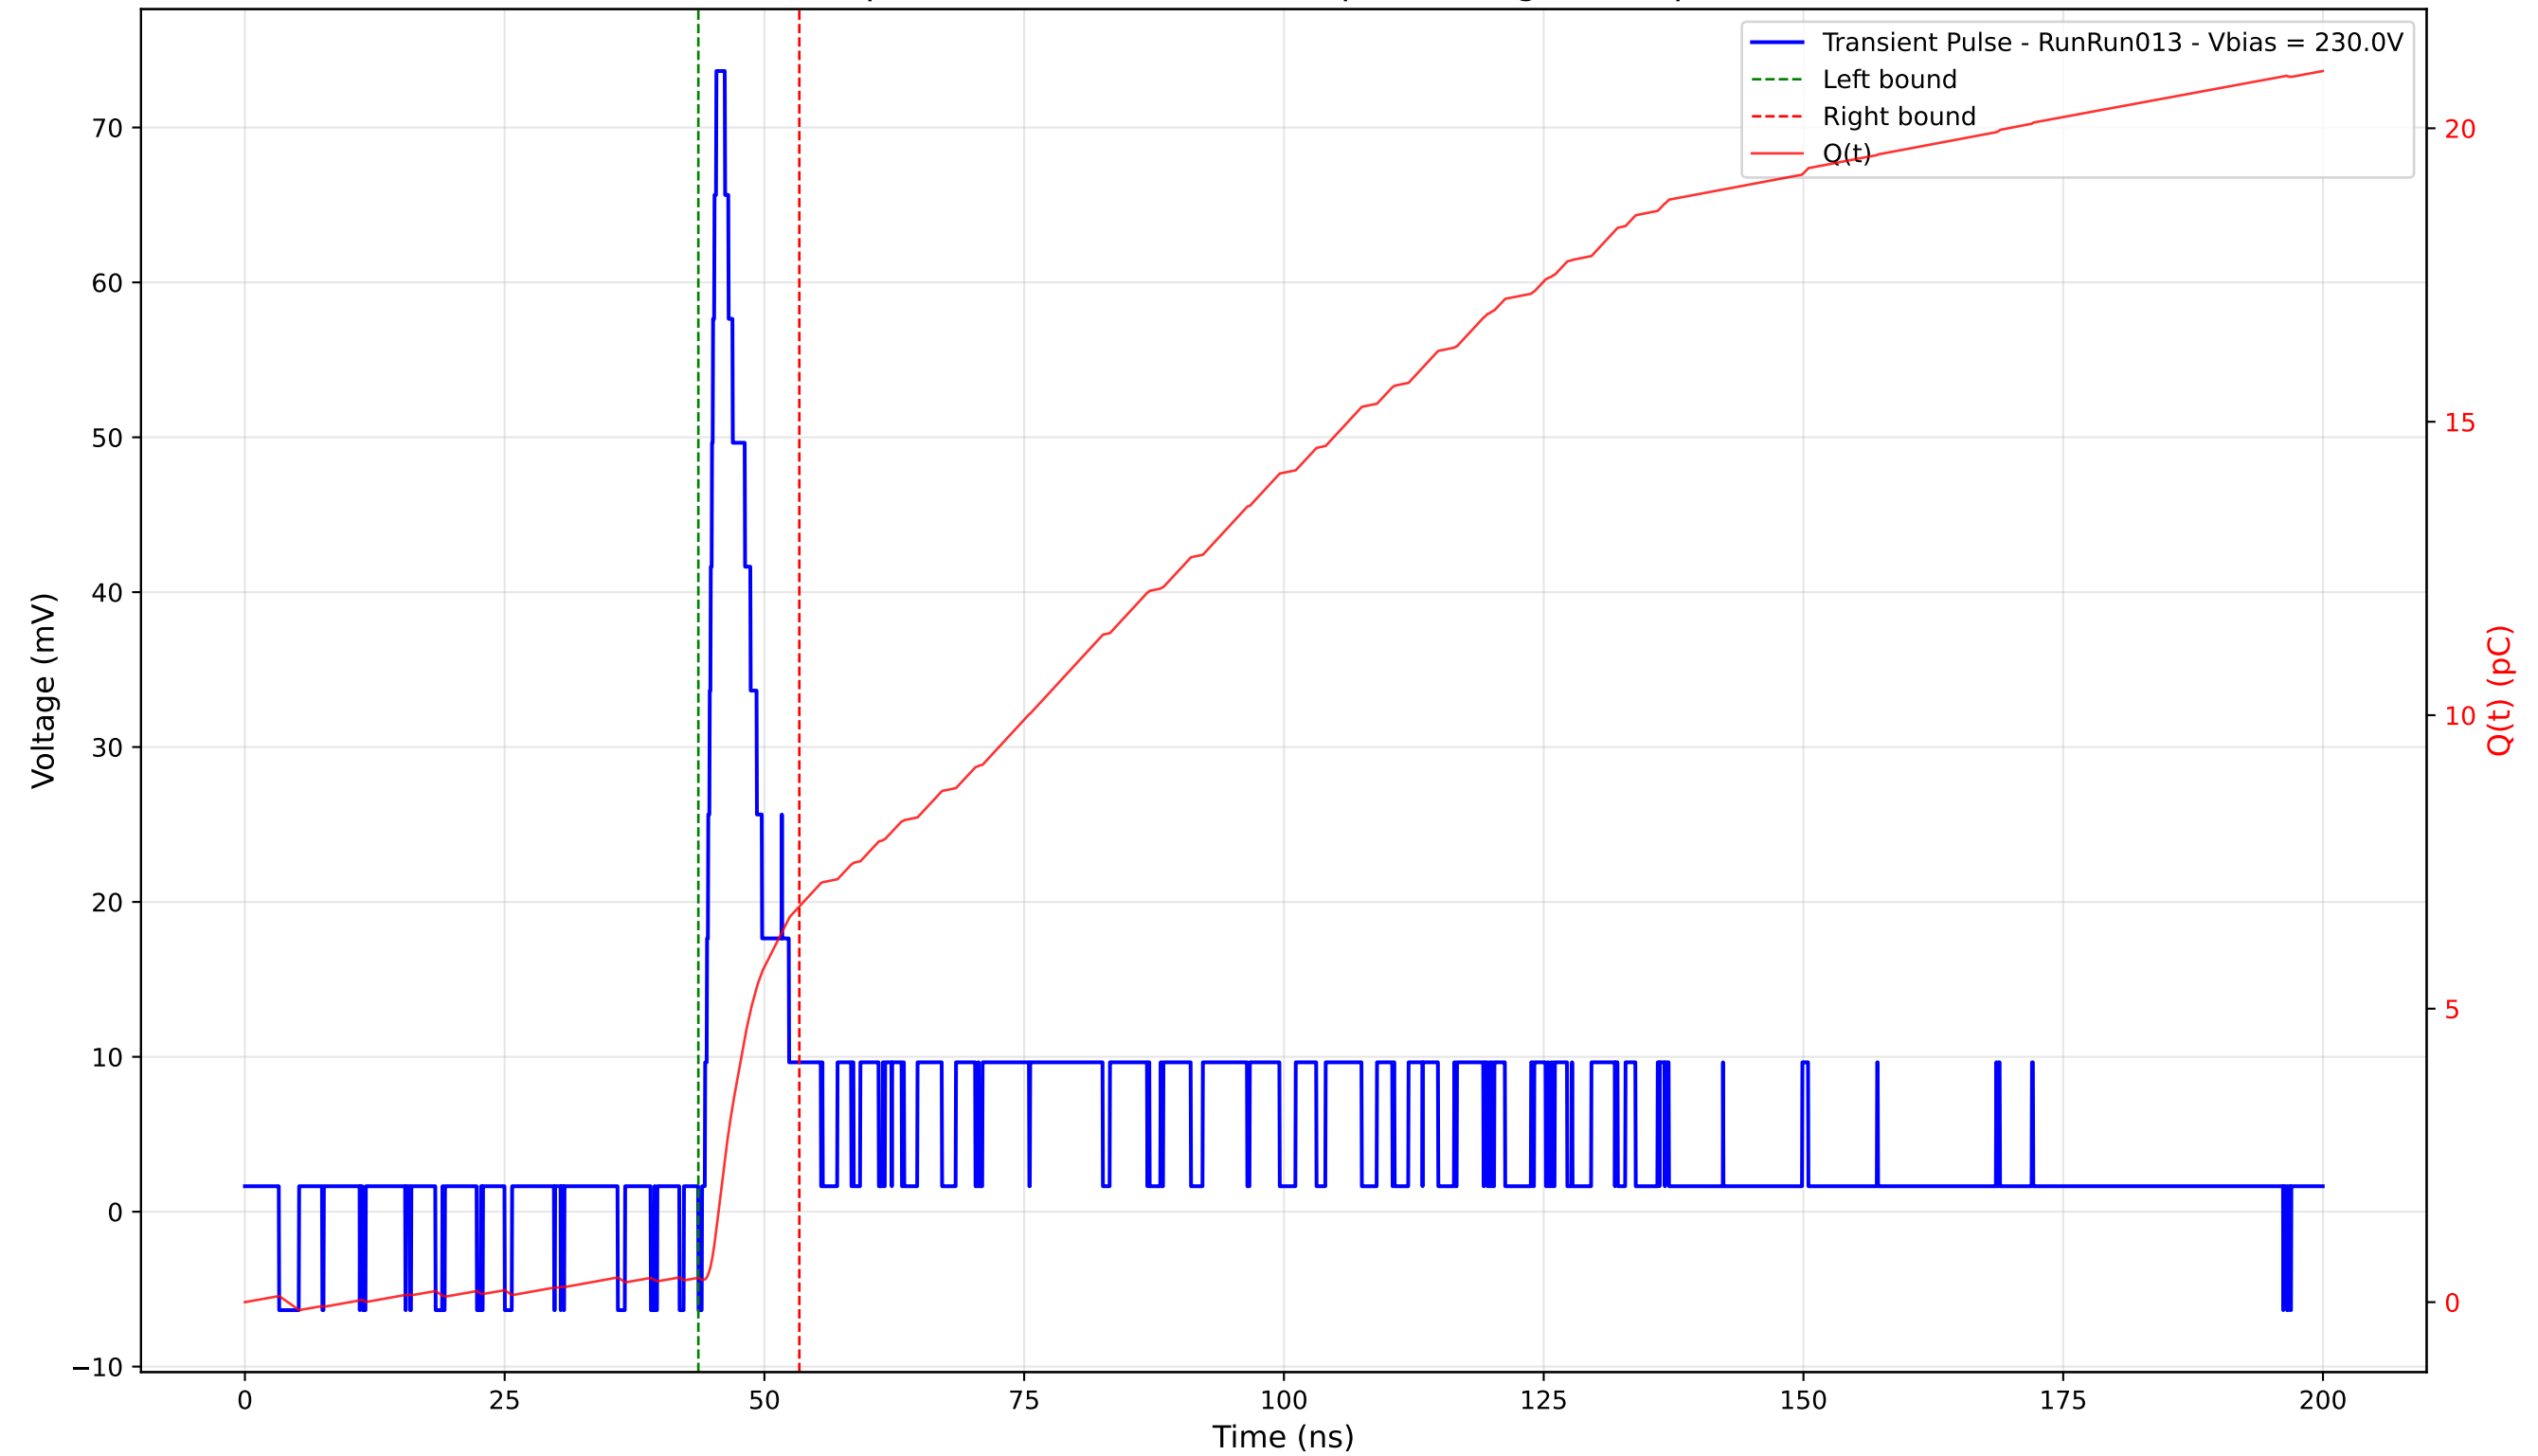


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 6.56 pC - Rise Time: 1.08 ns

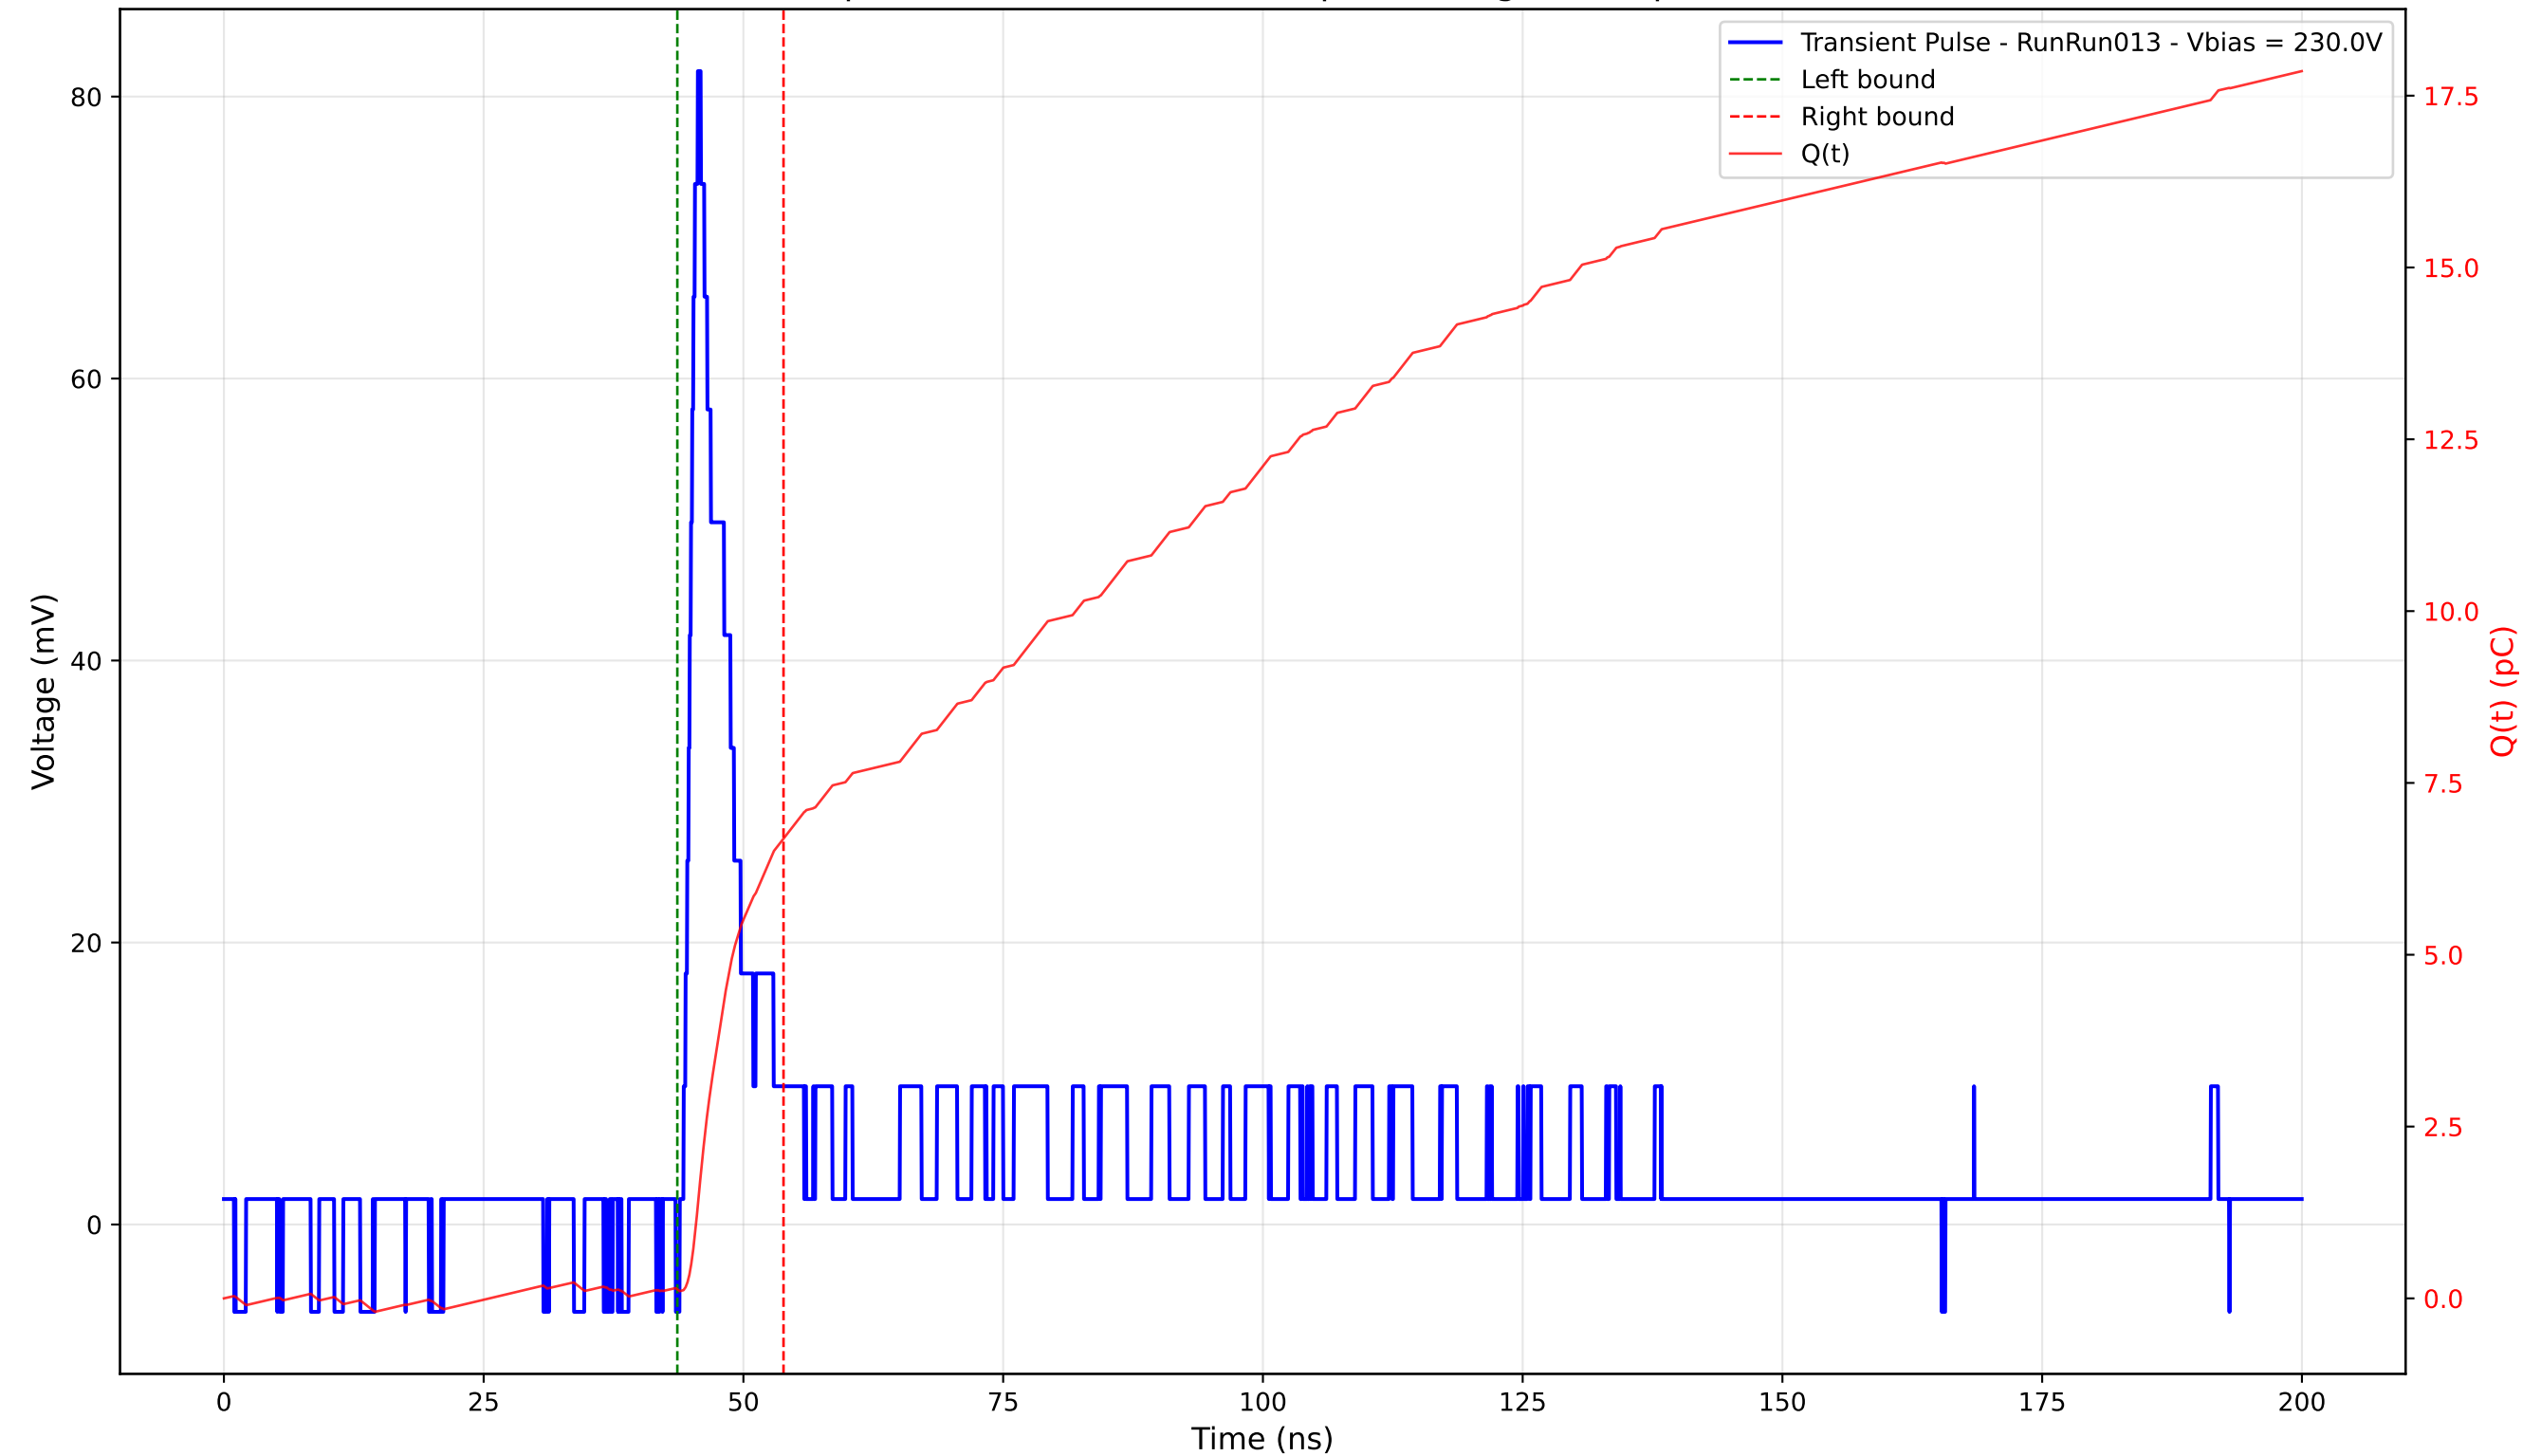


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 5.52 pC - Rise Time: 1.32 ns

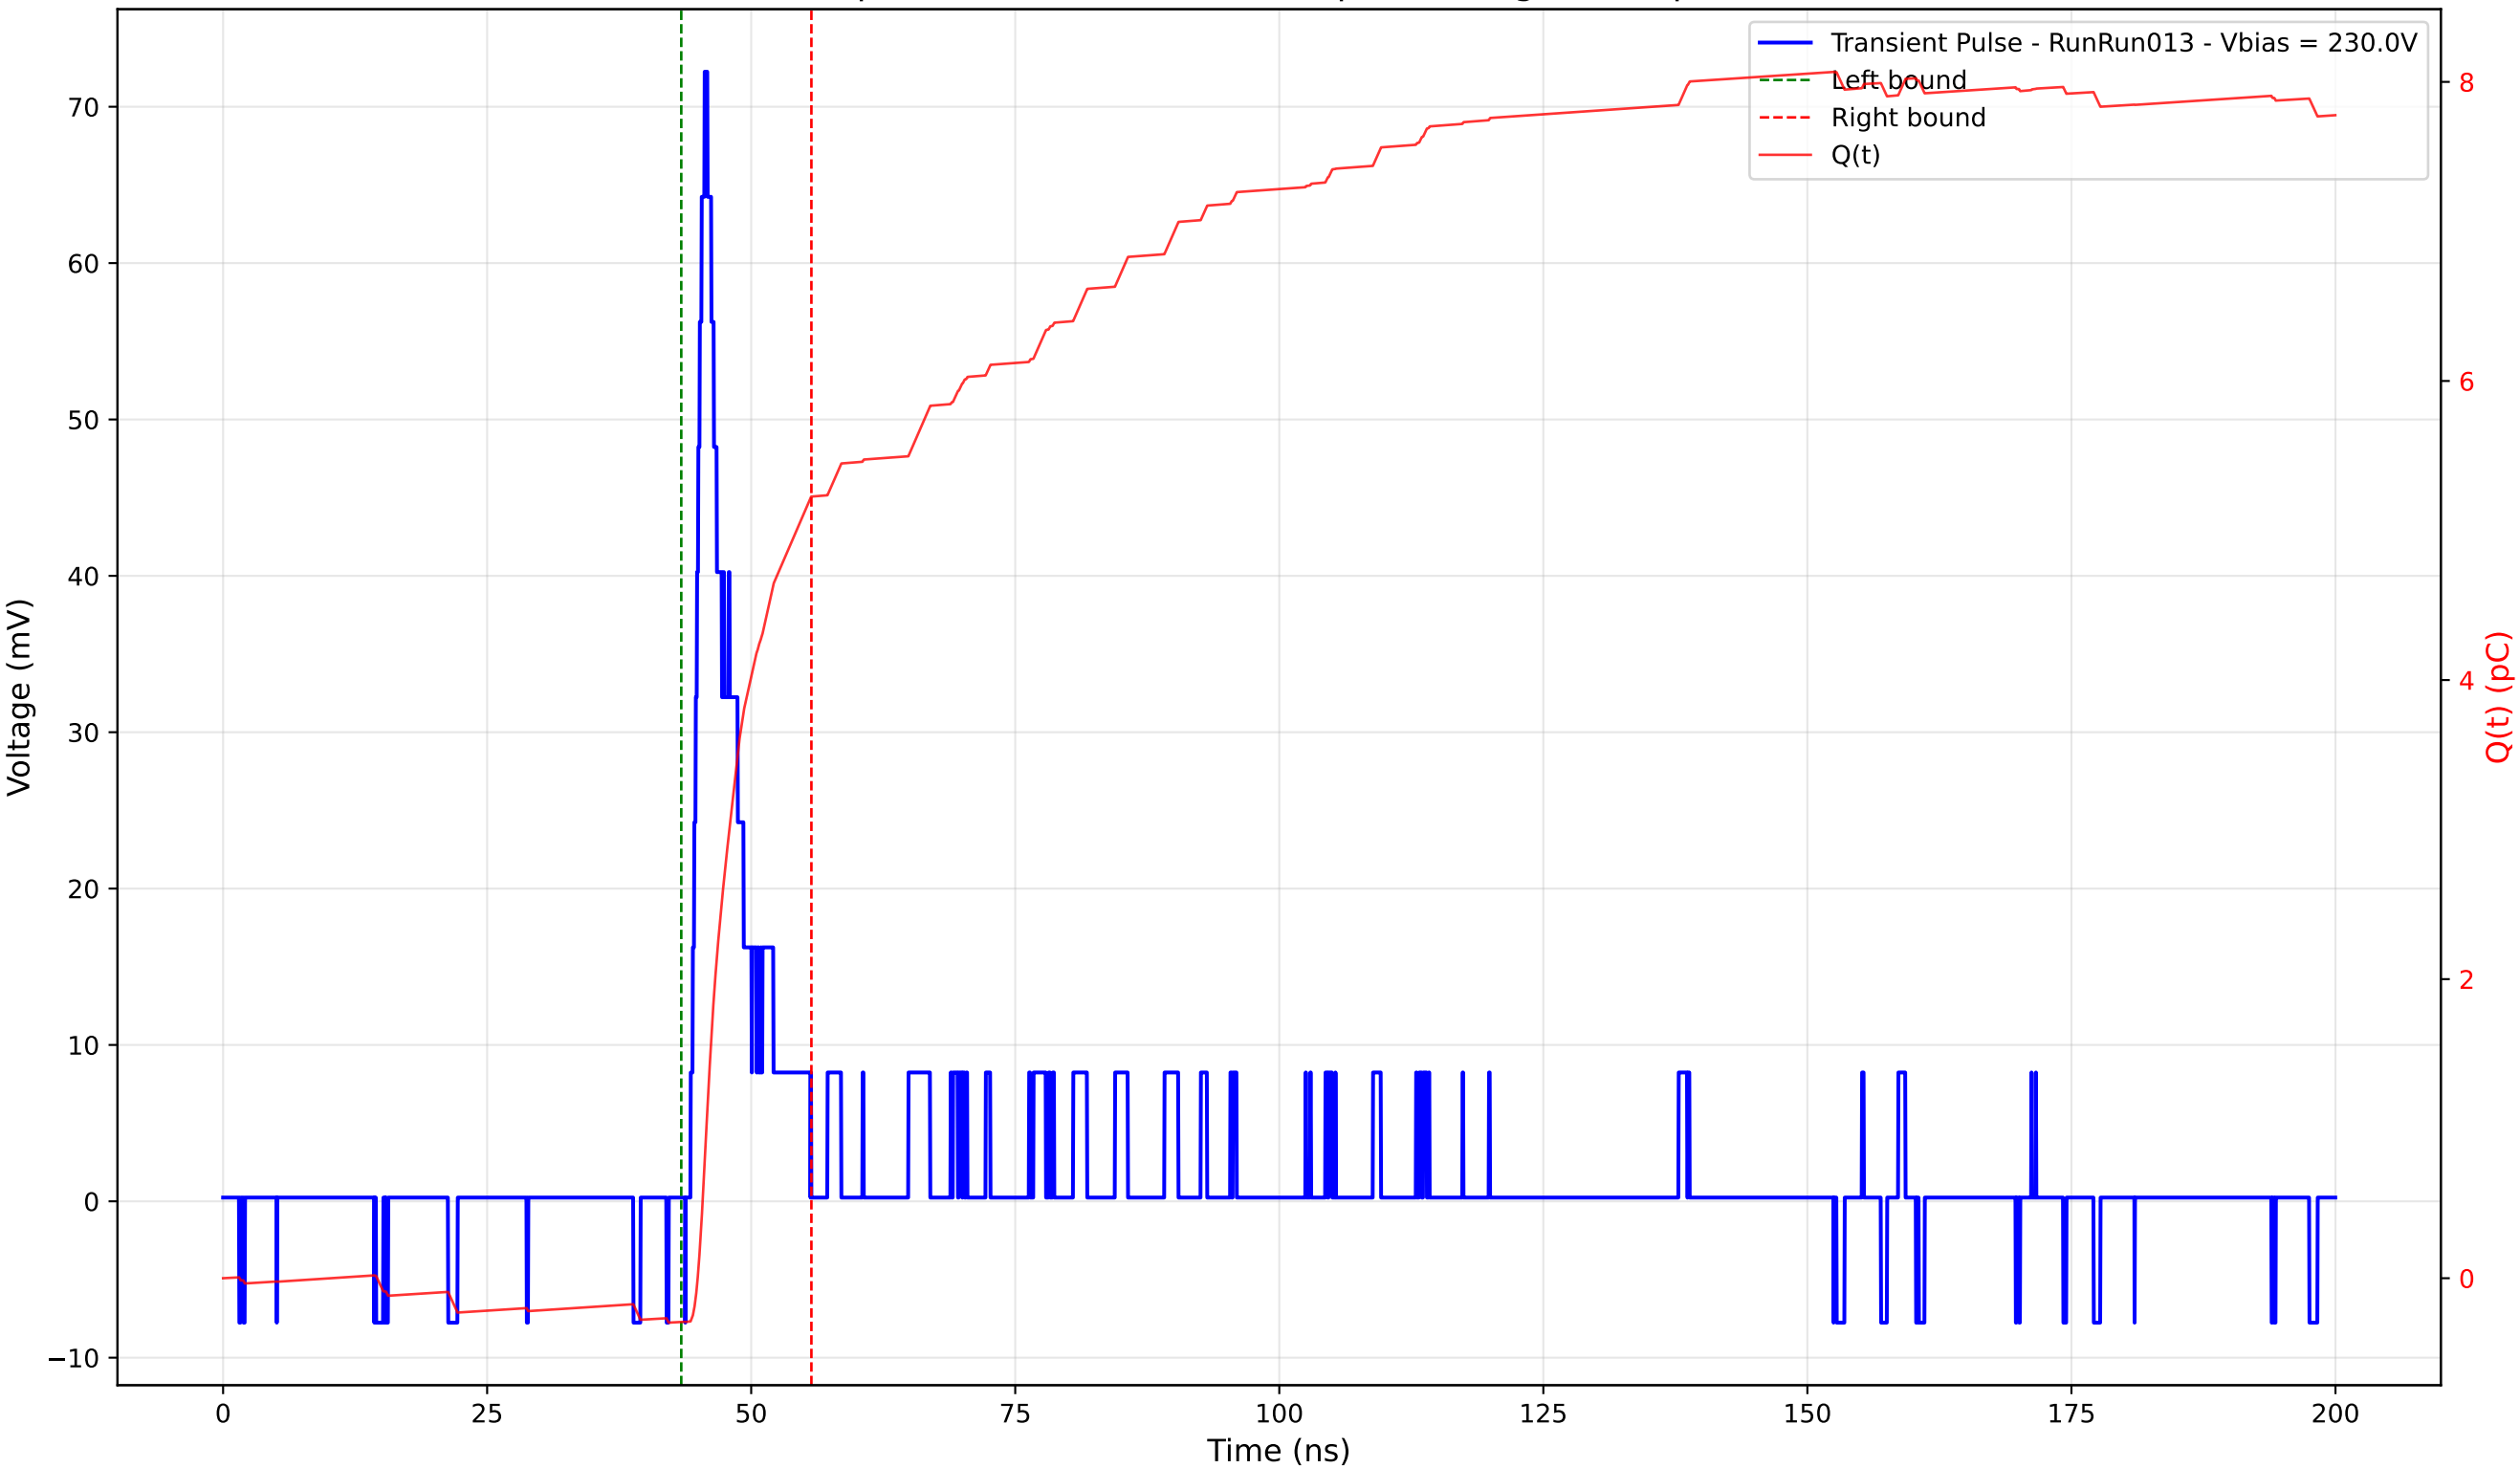


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 4.90 pC - Rise Time: 1.11 ns

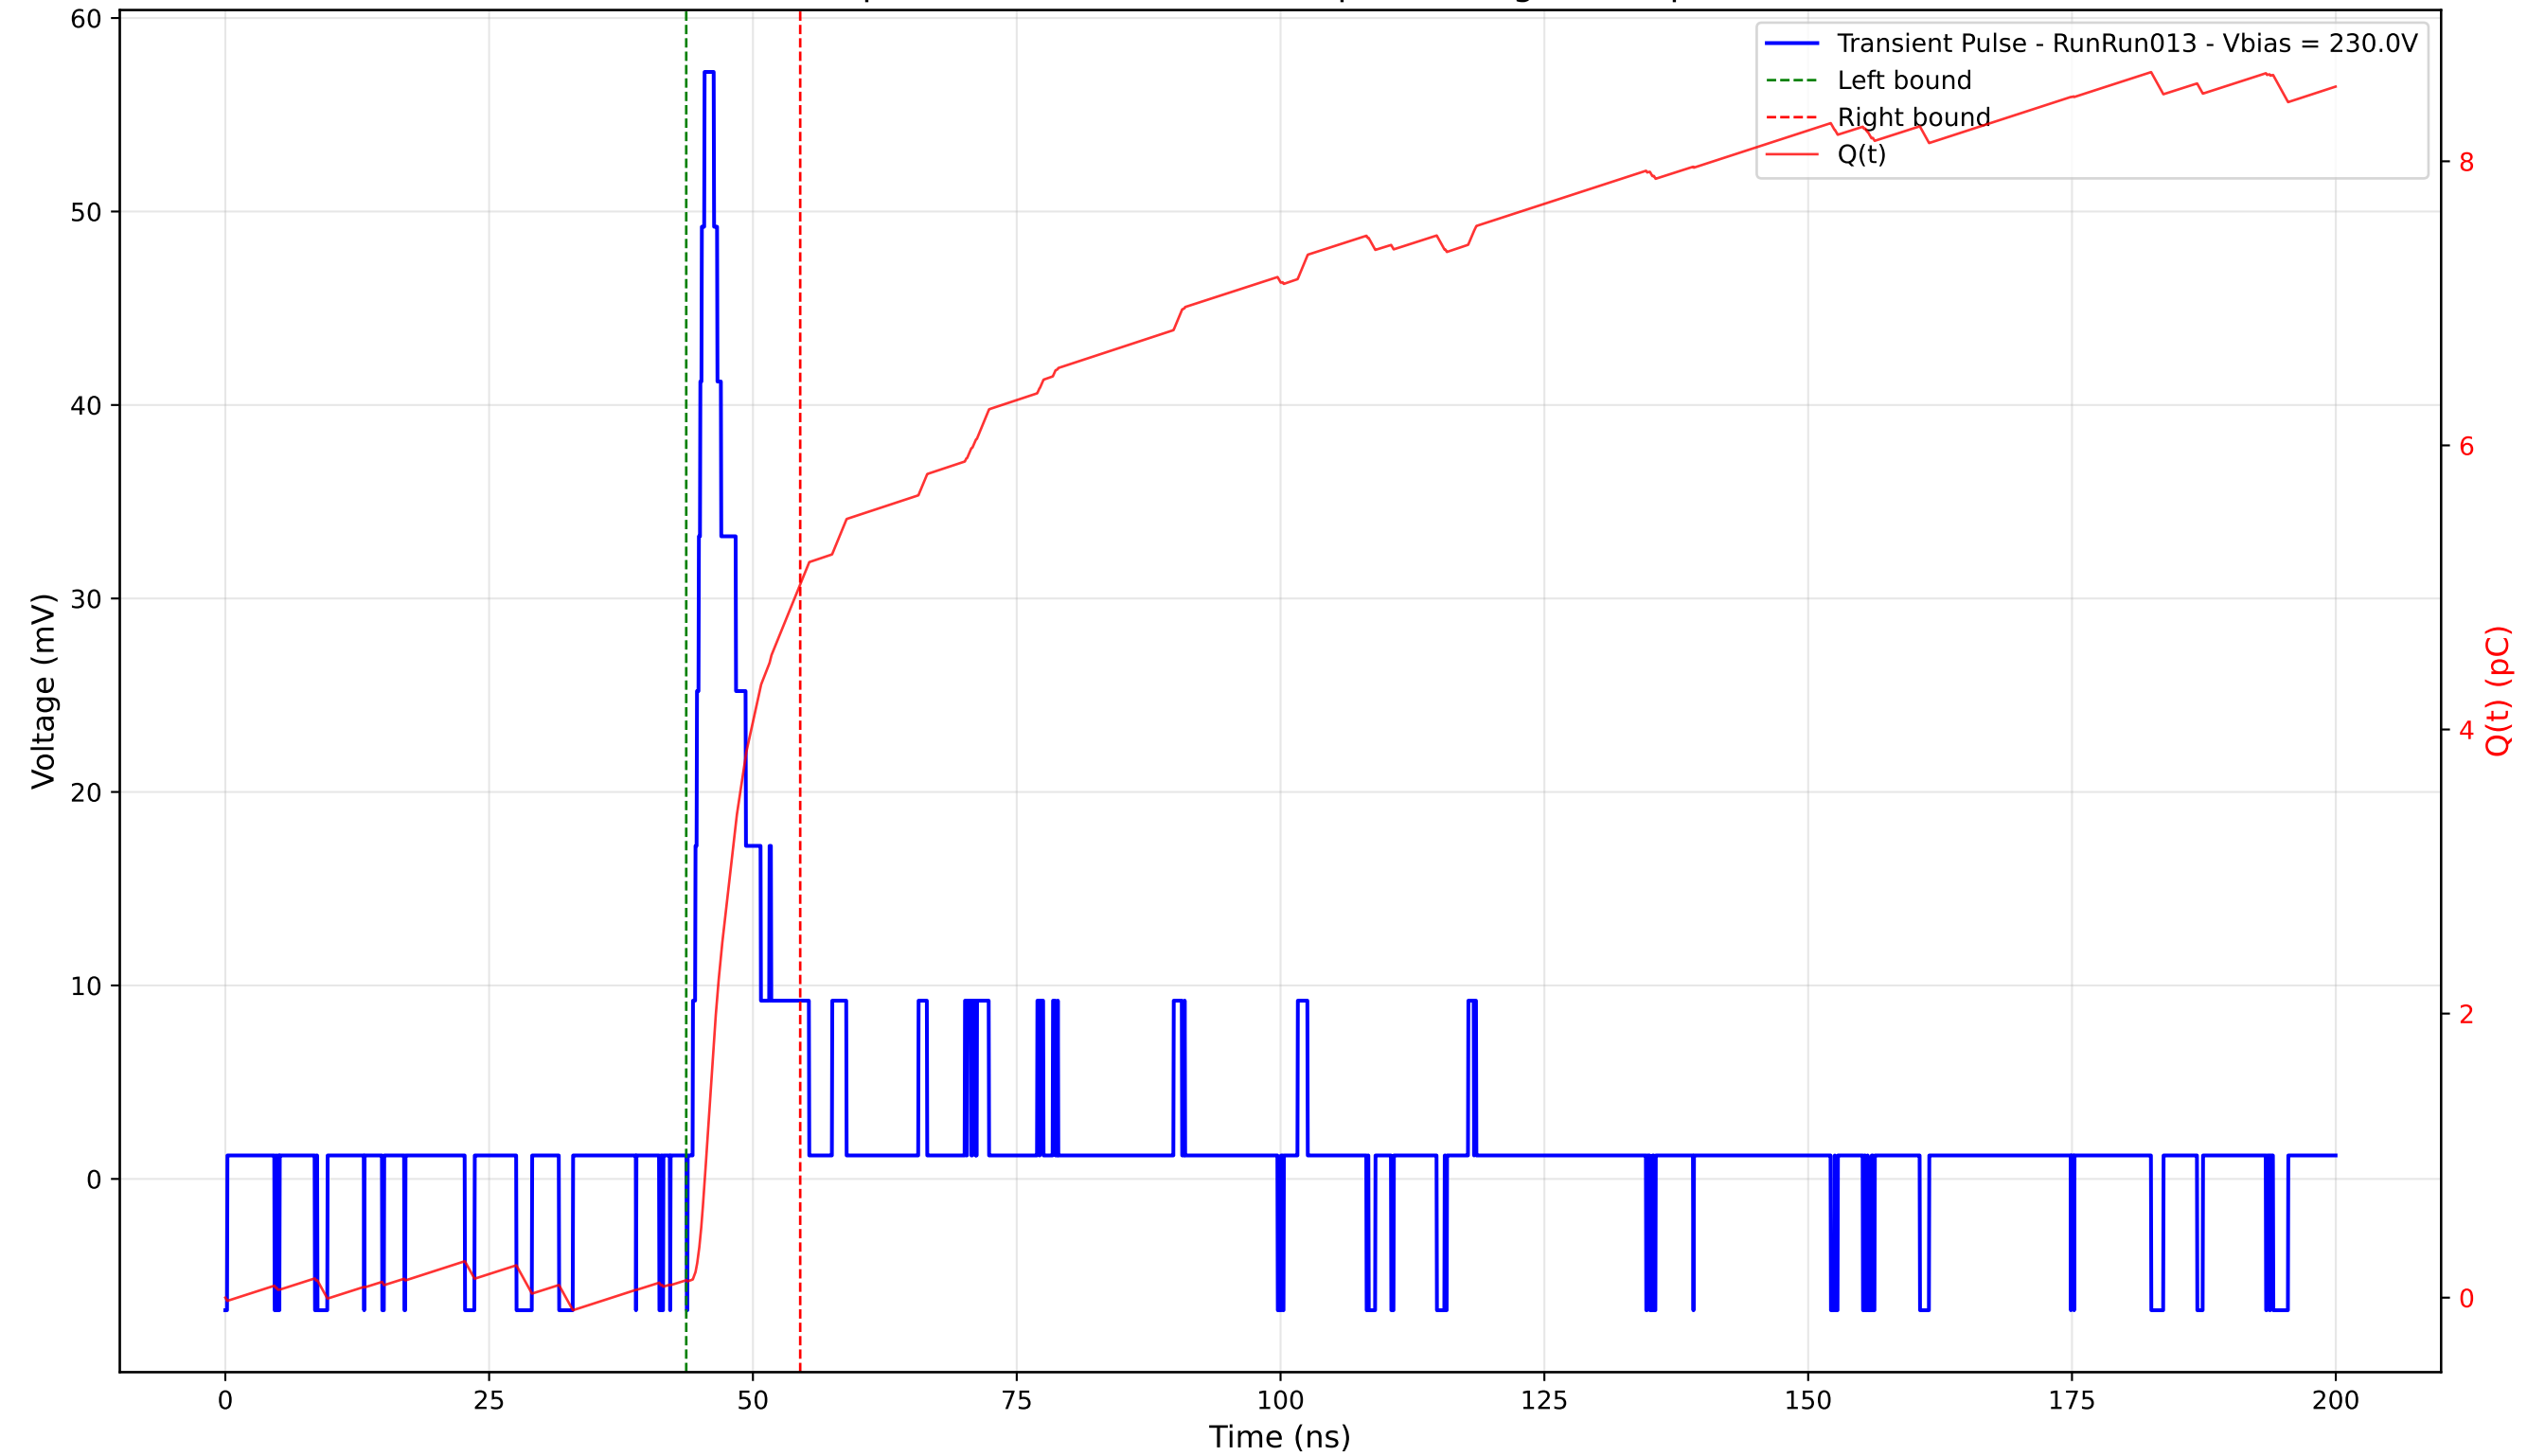


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 2.82 pC - Rise Time: 0.96 ns

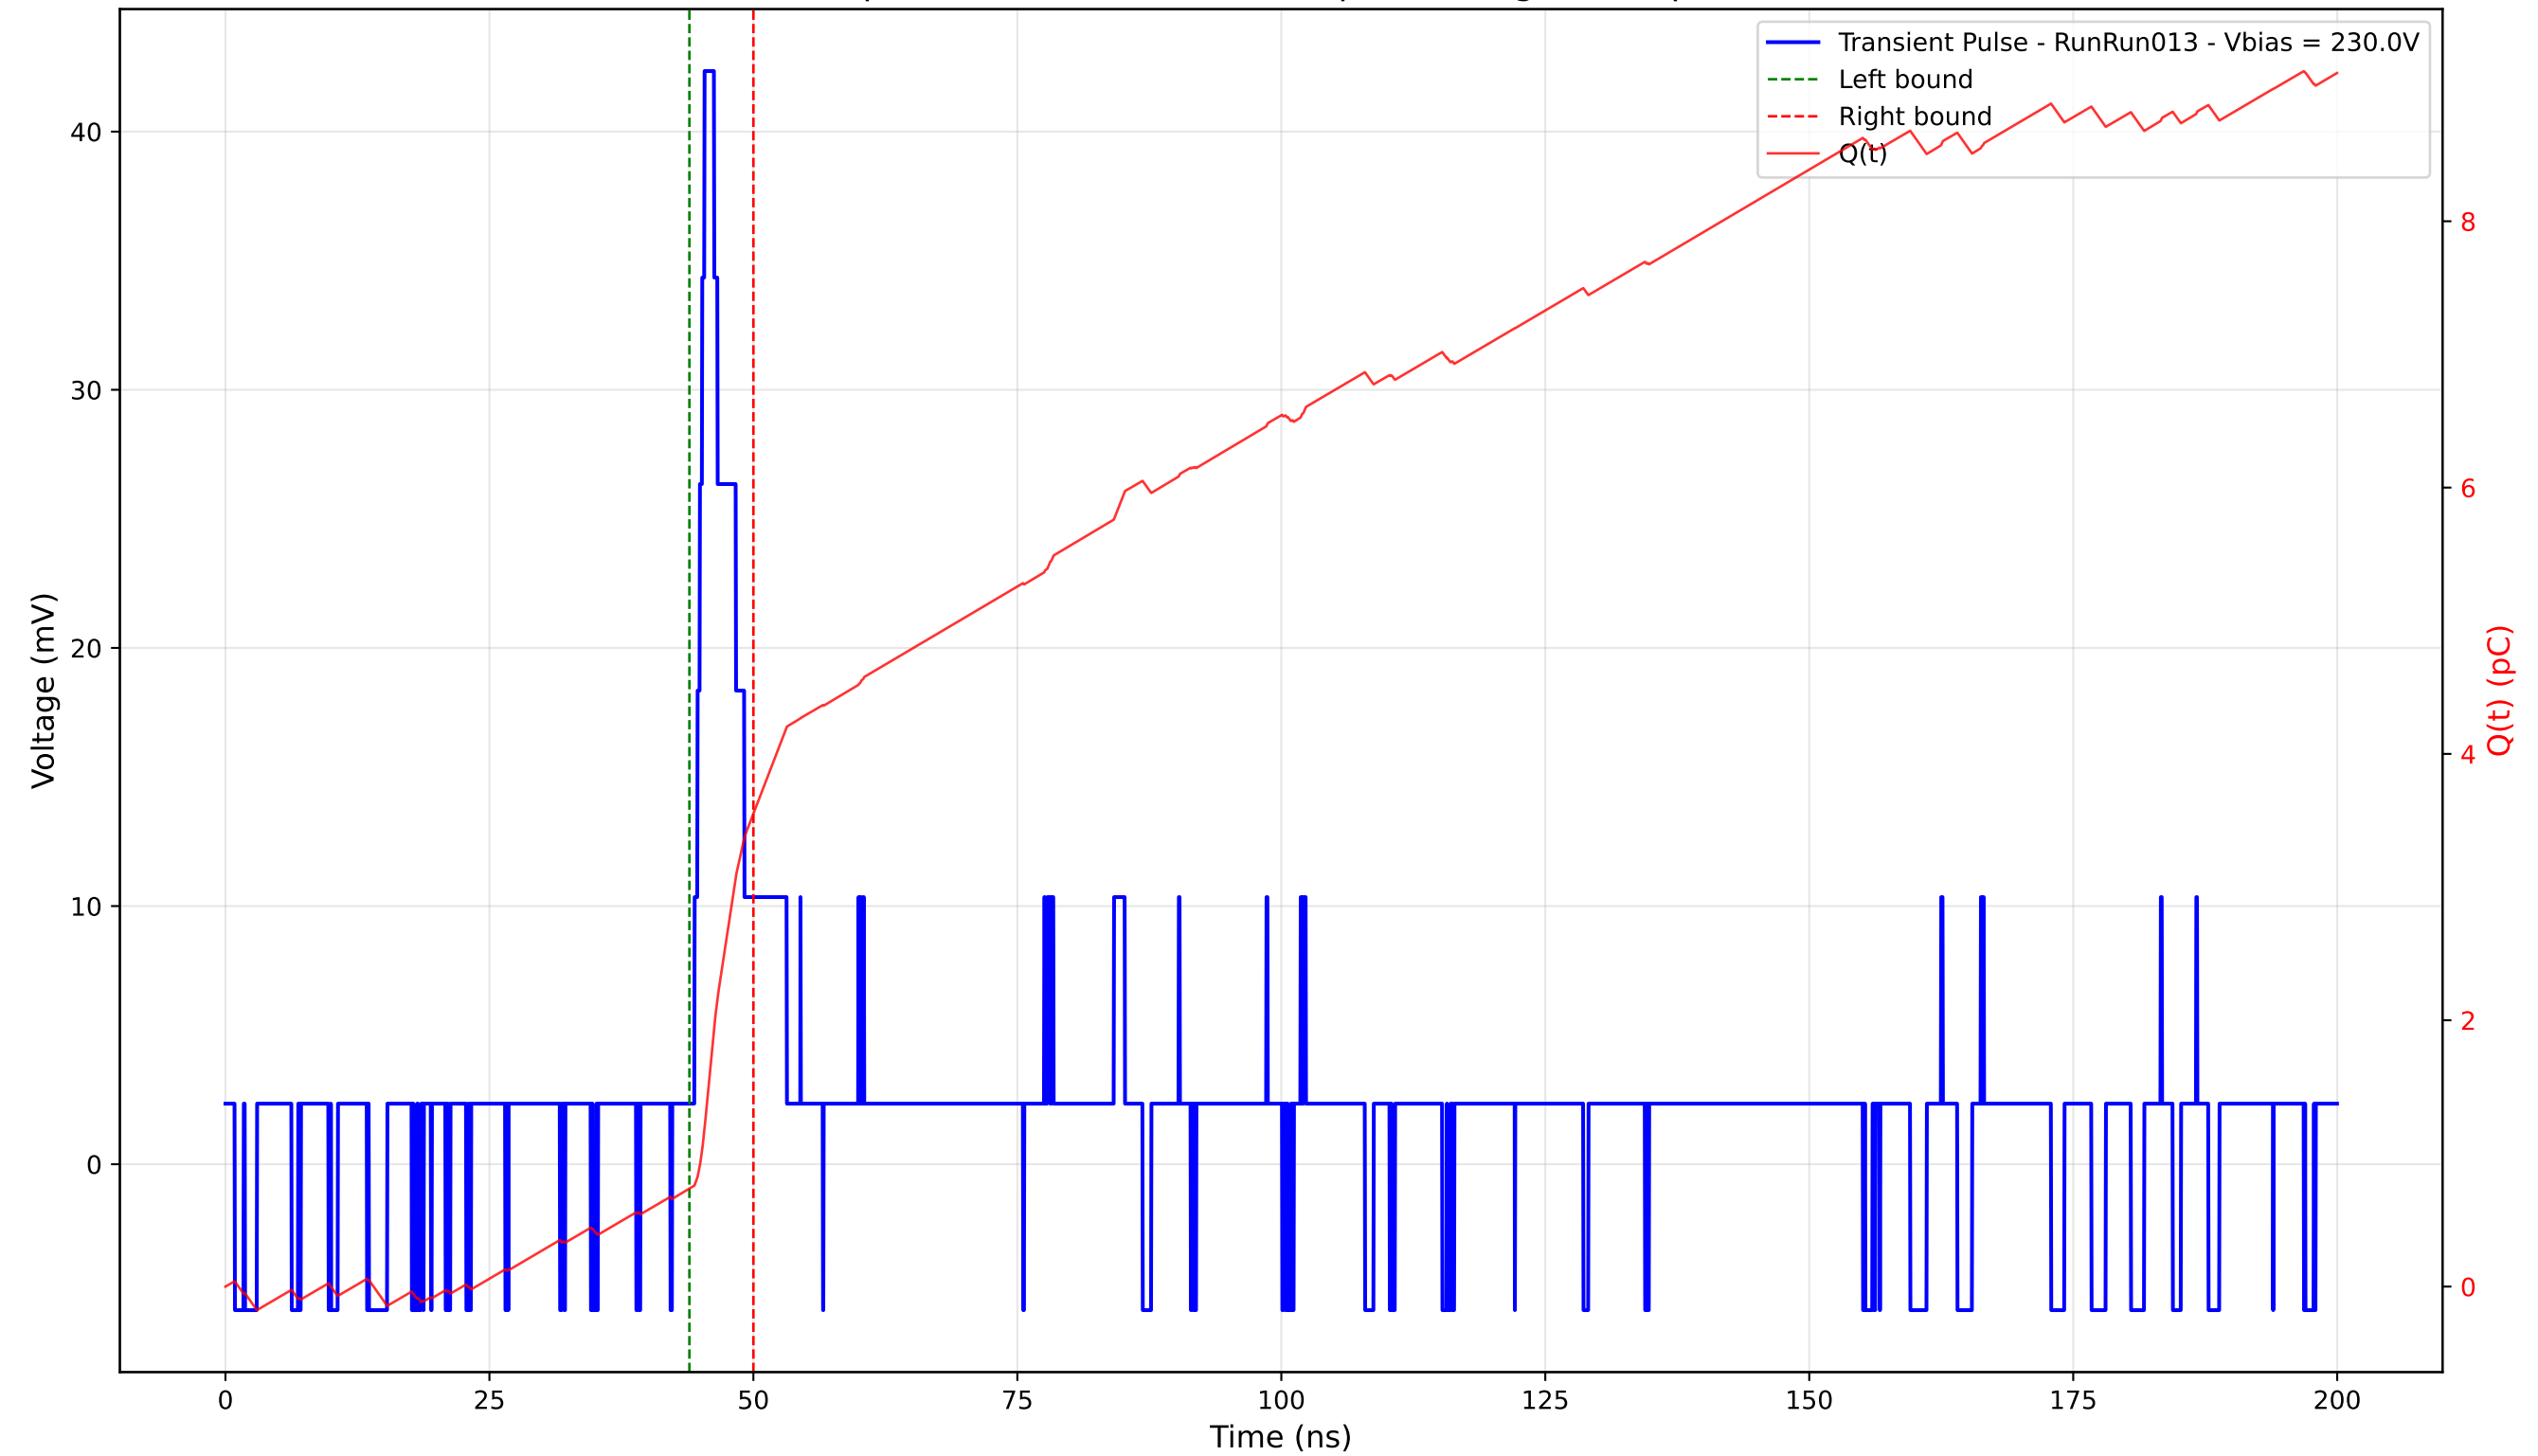

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.57 pC - Rise Time: 0.00 ns (N/A)

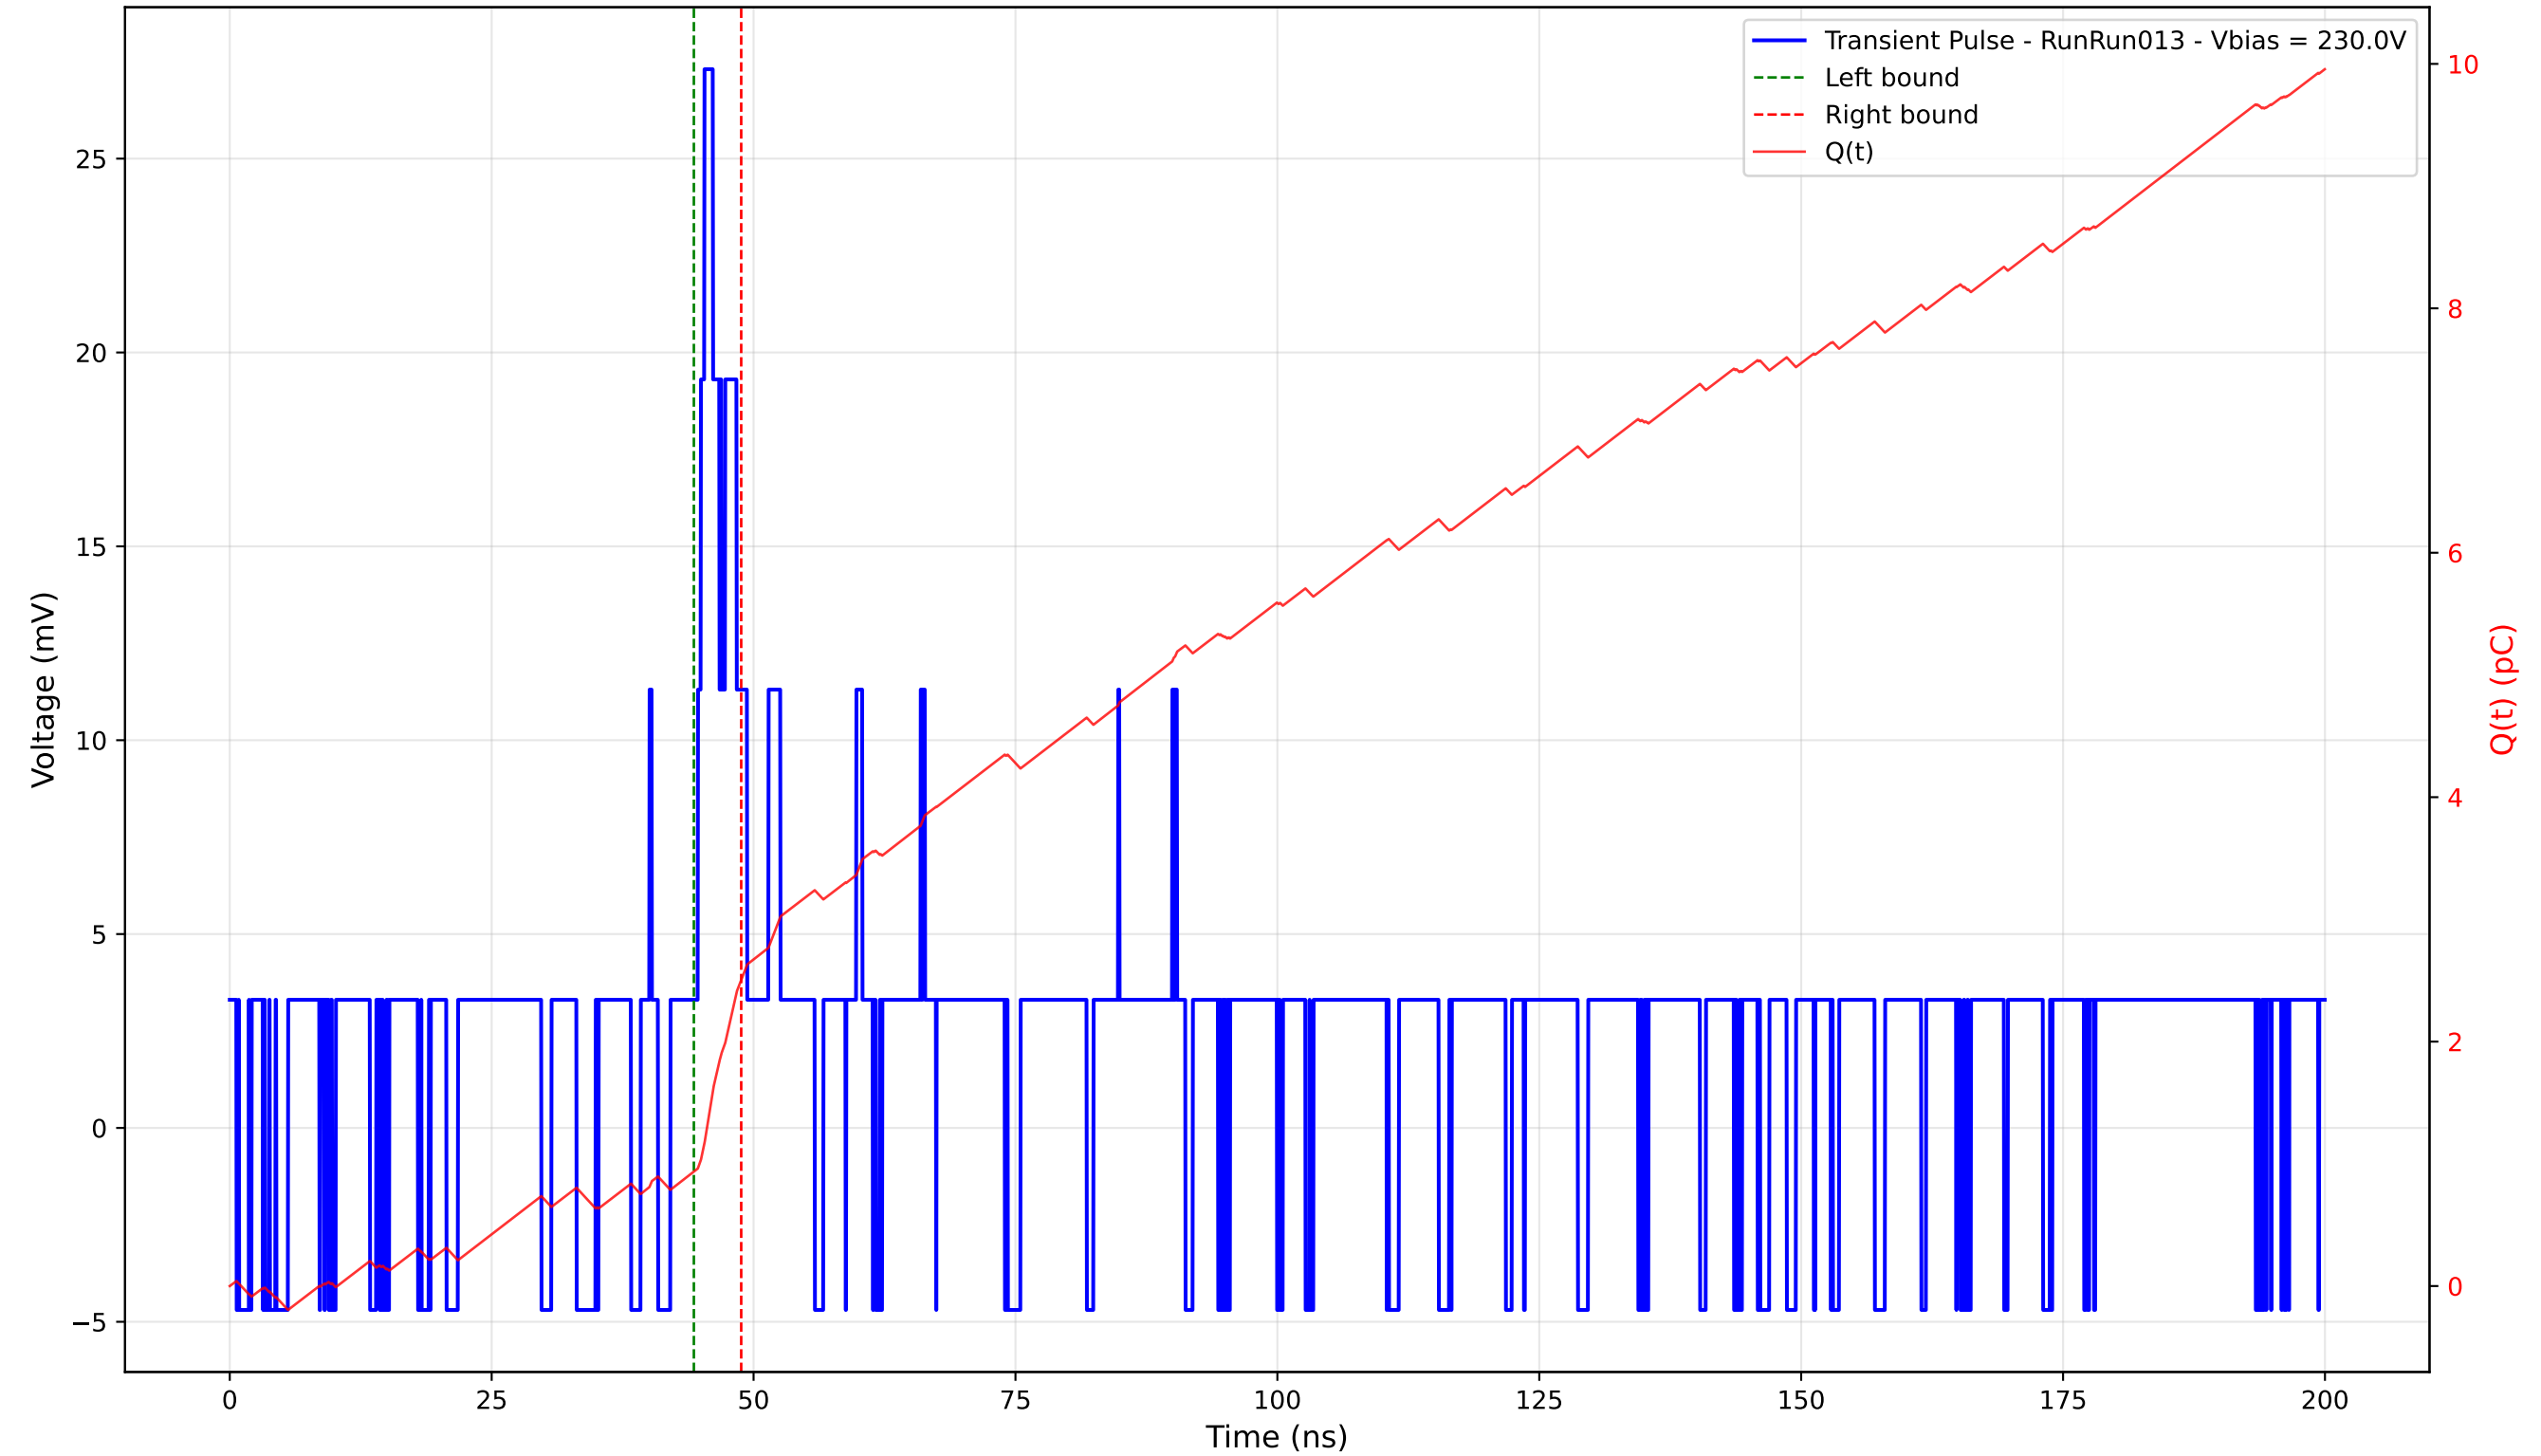

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 1.65 pC - Rise Time: 0.52 ns

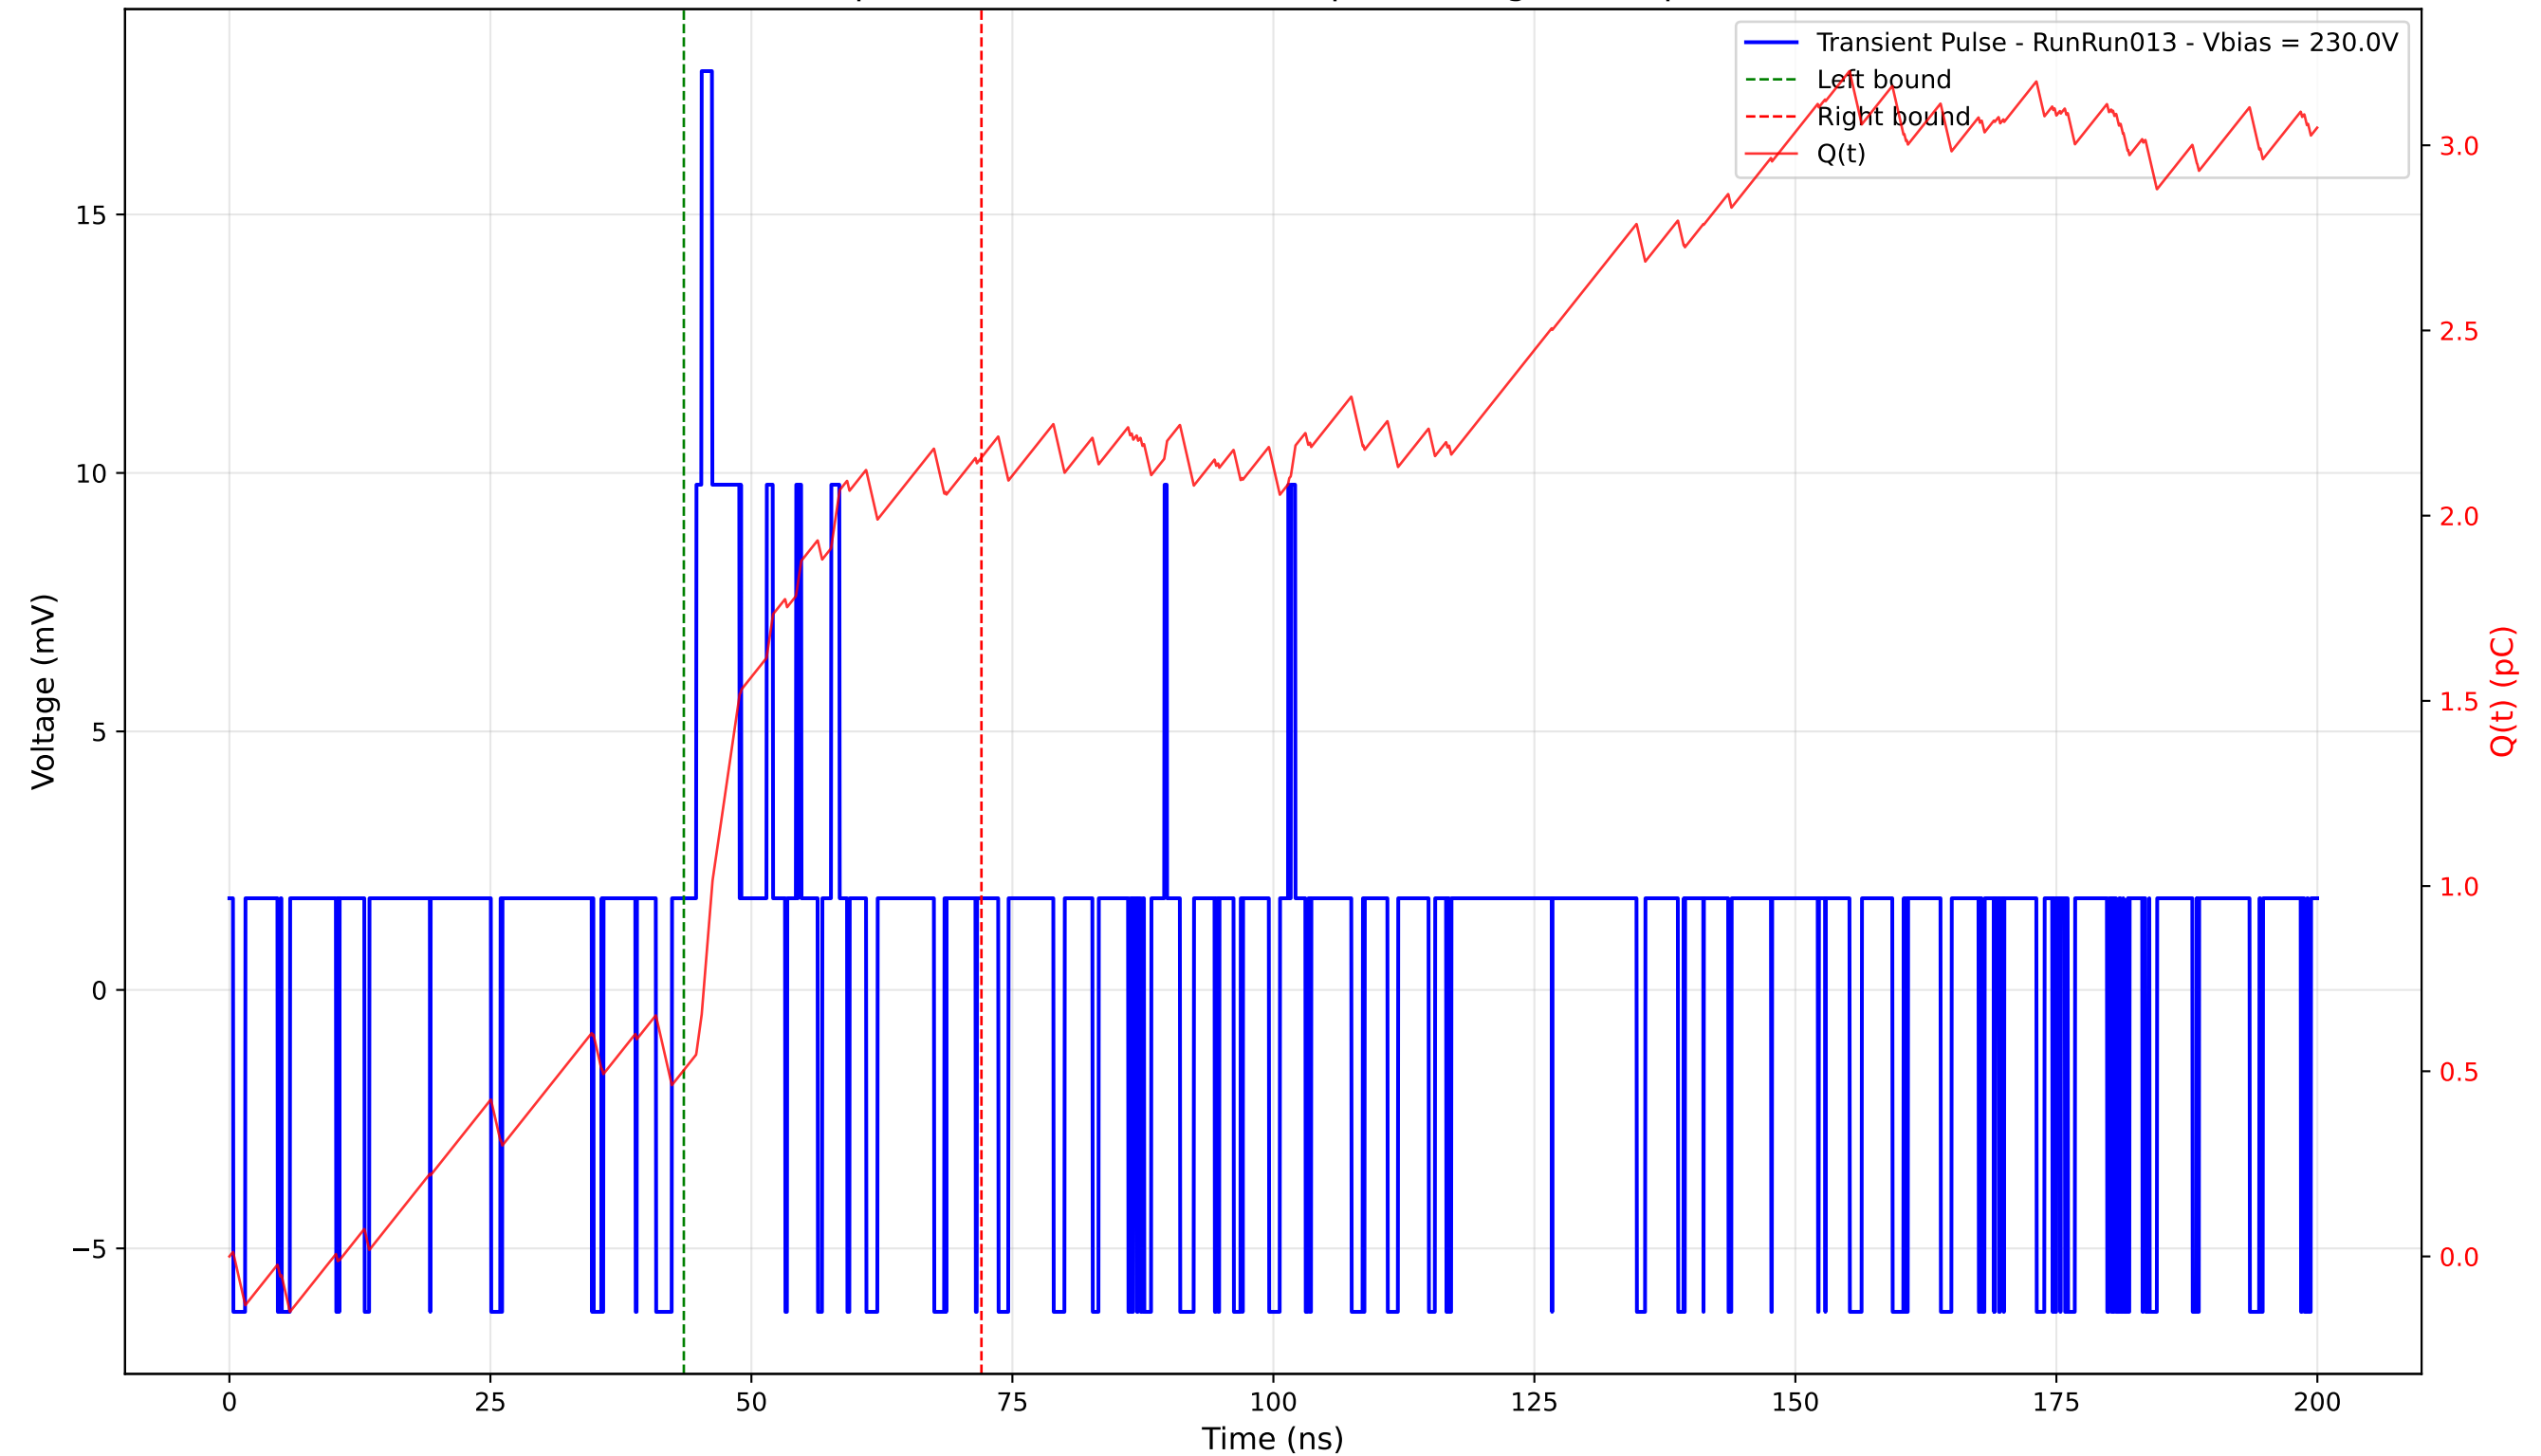

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 0.31 pC - Rise Time: 0.38 ns

