



TCT Run Run018 Summary

Parameter	Value
Run	Run018
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	140.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\140V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A


Collected Charge

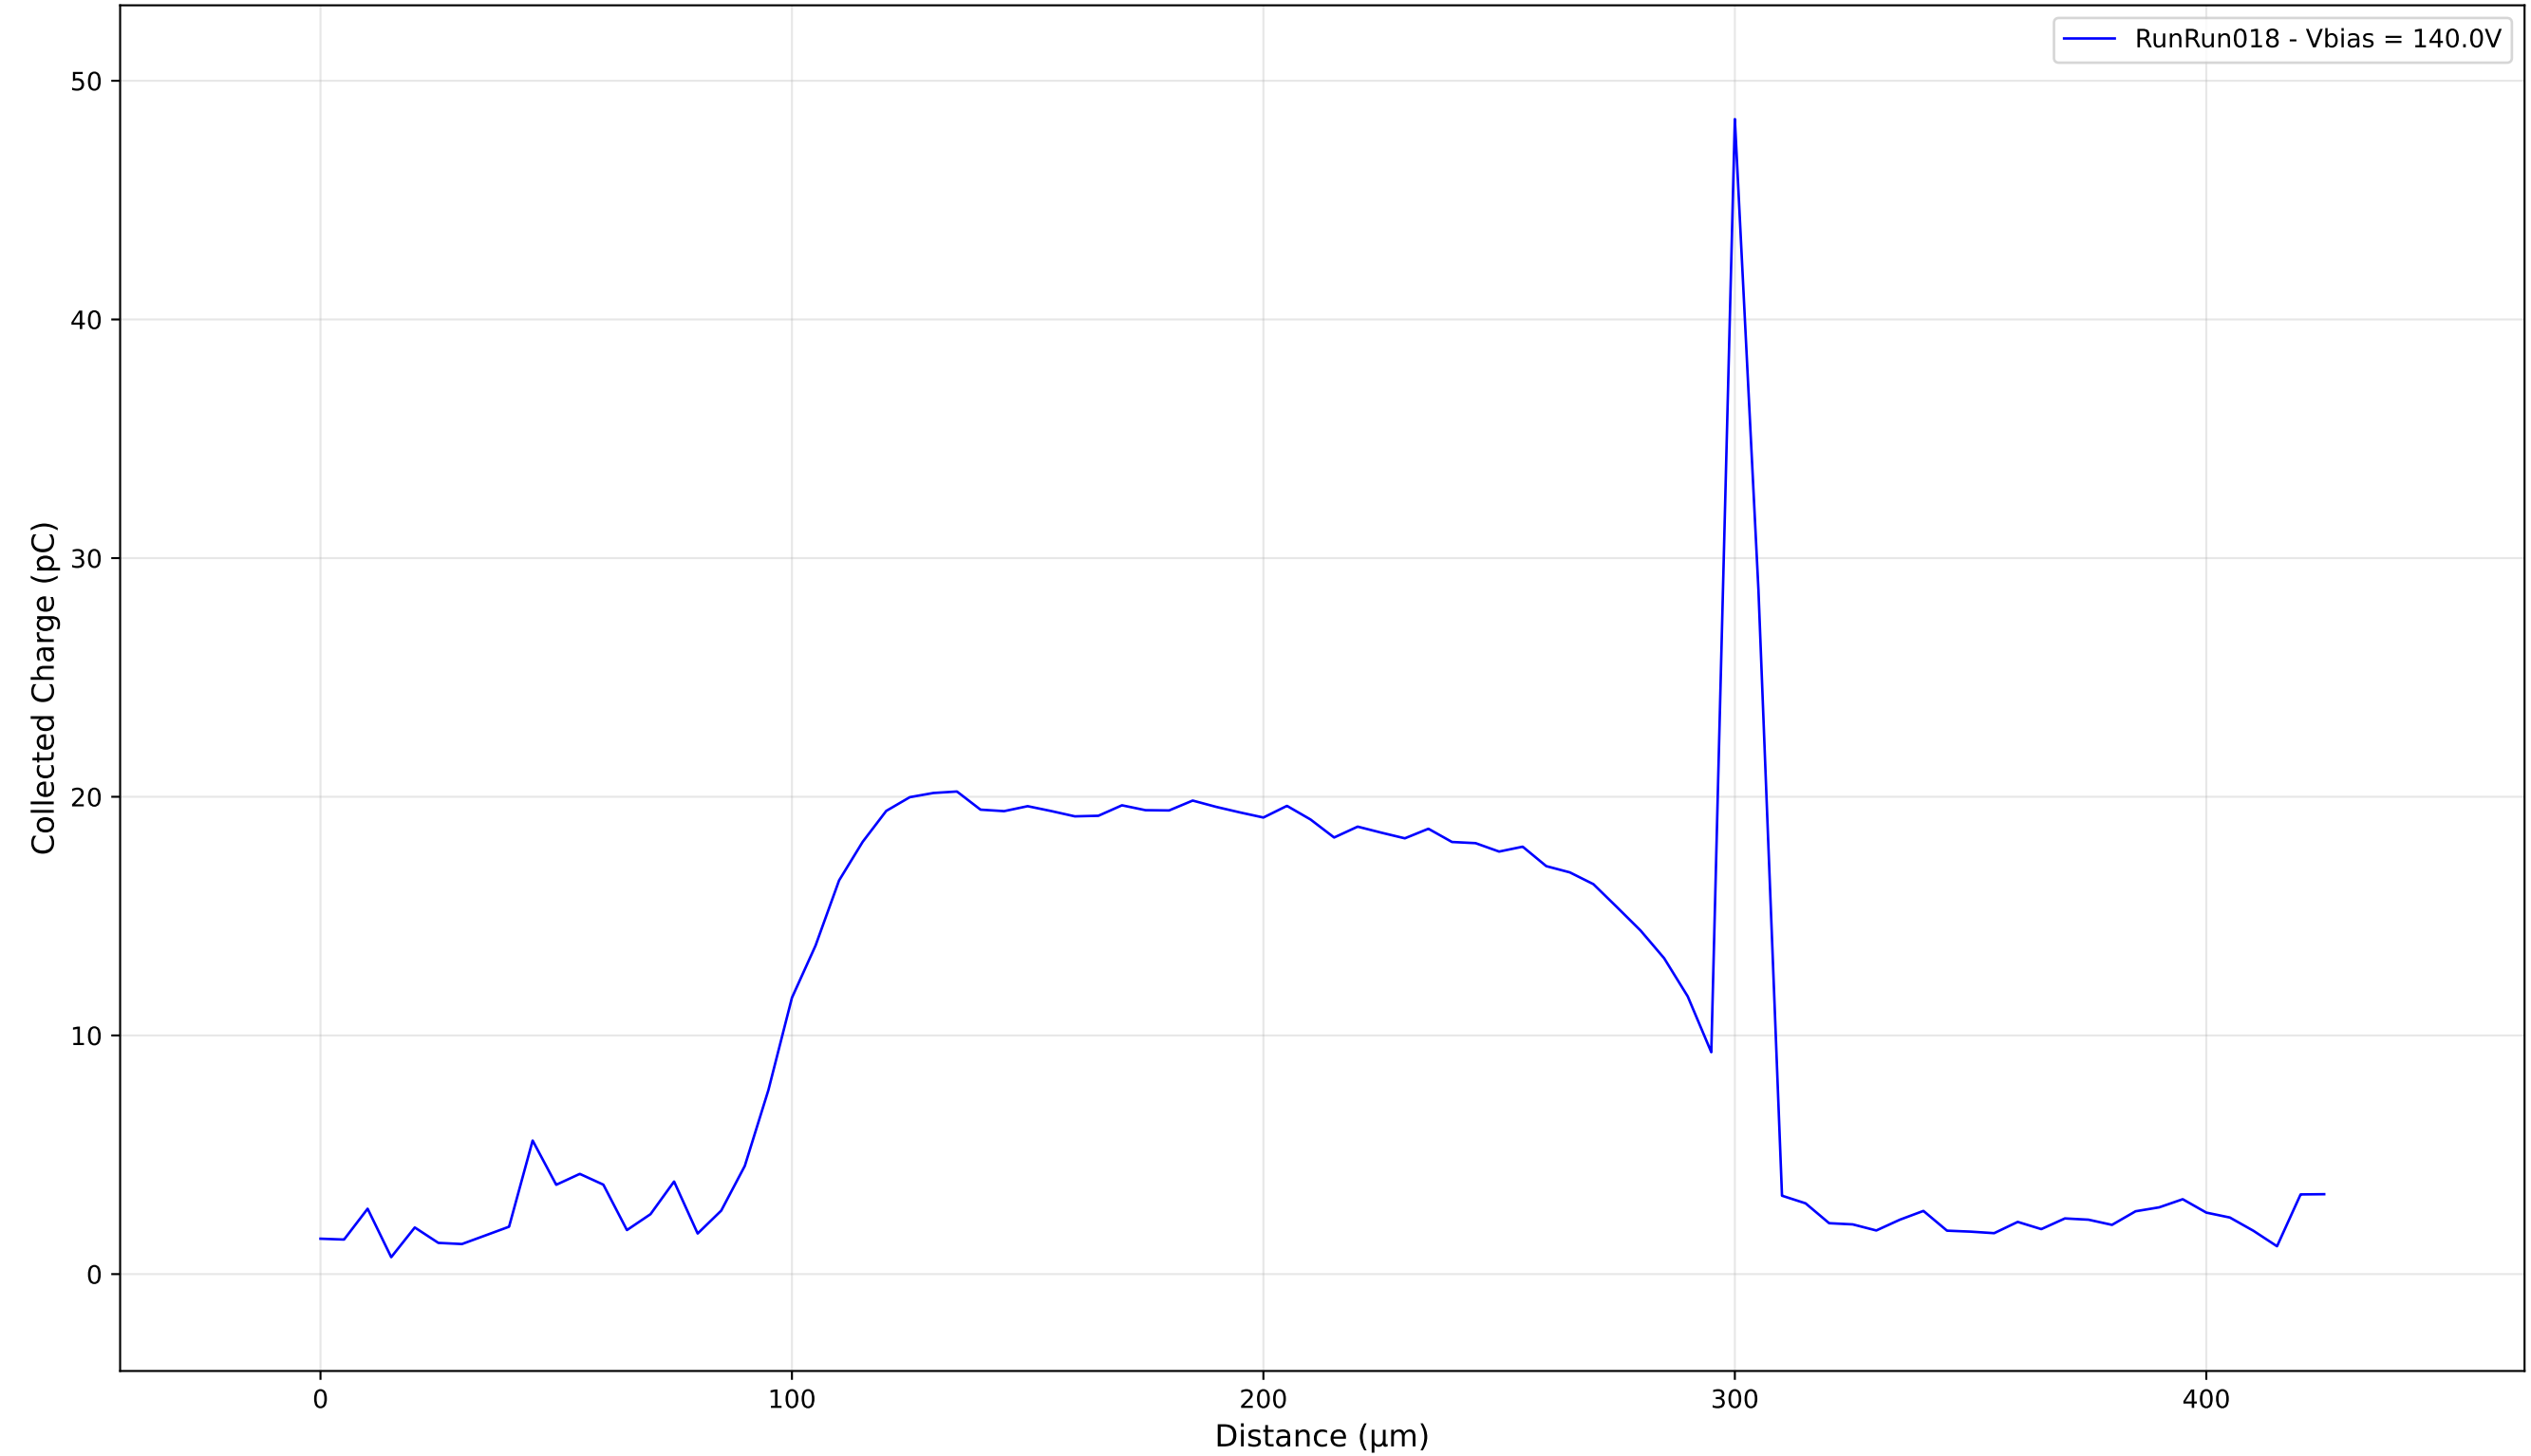


Collected Charge

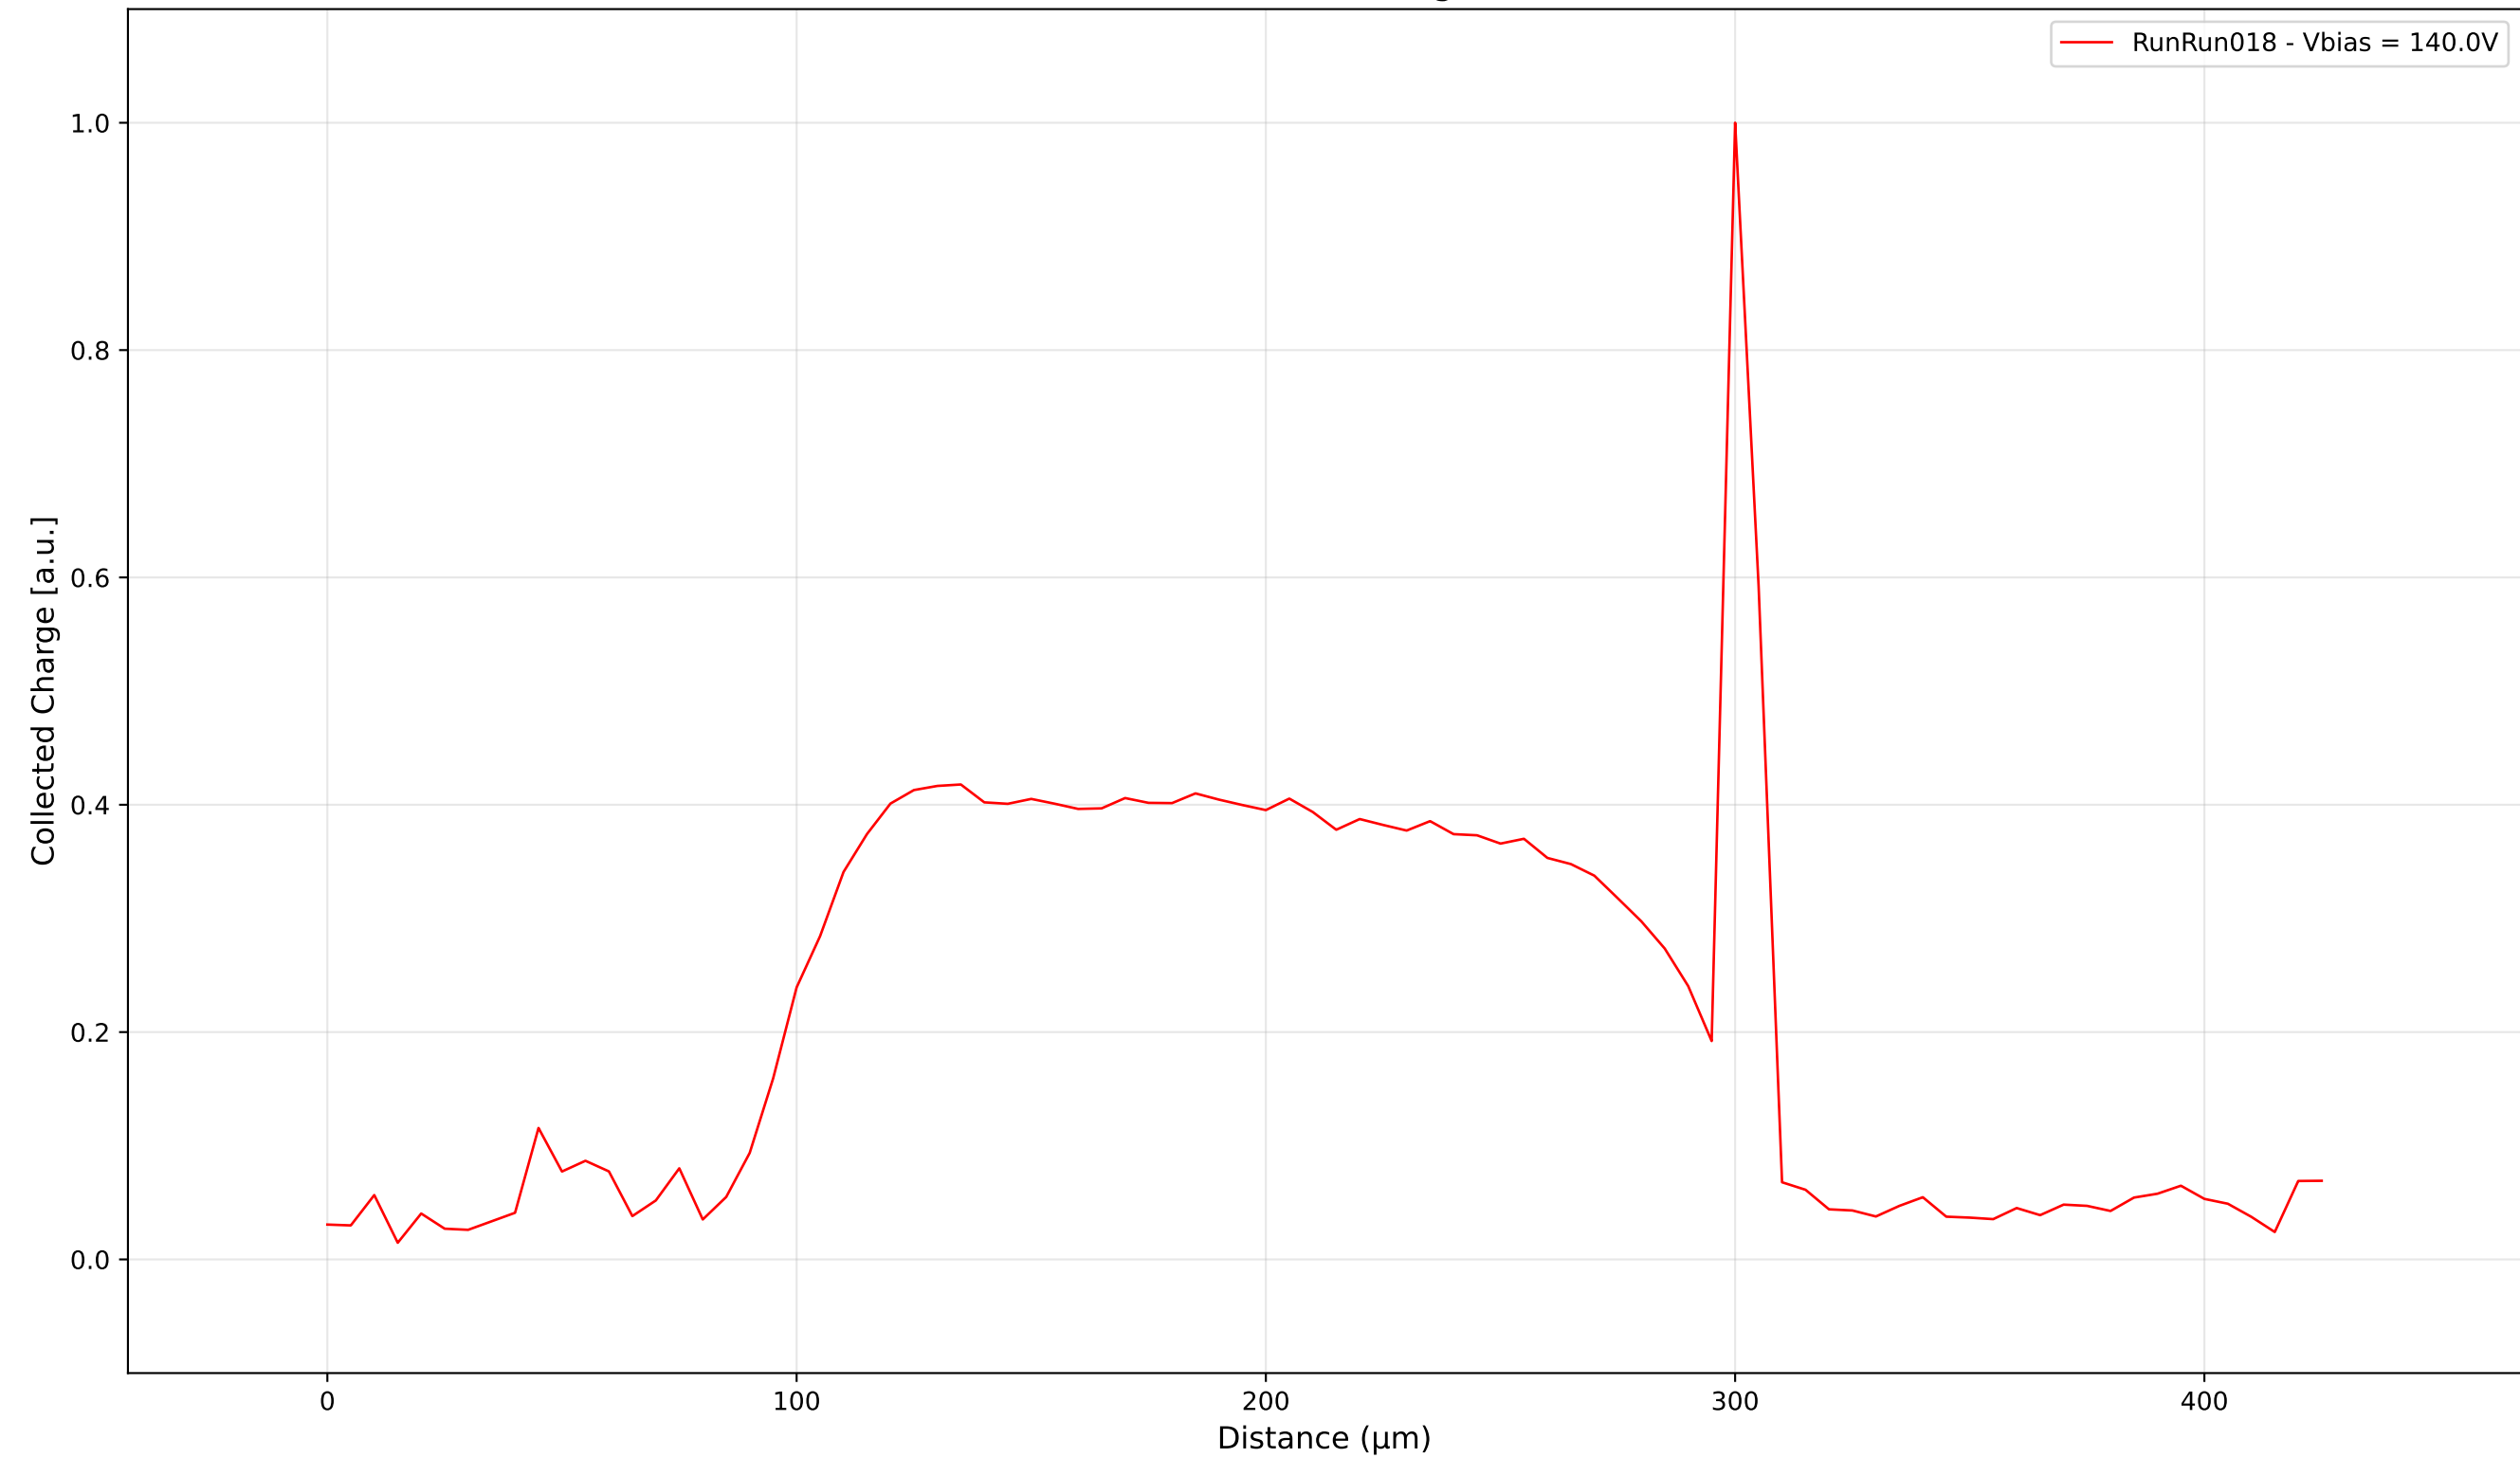


Rise Time

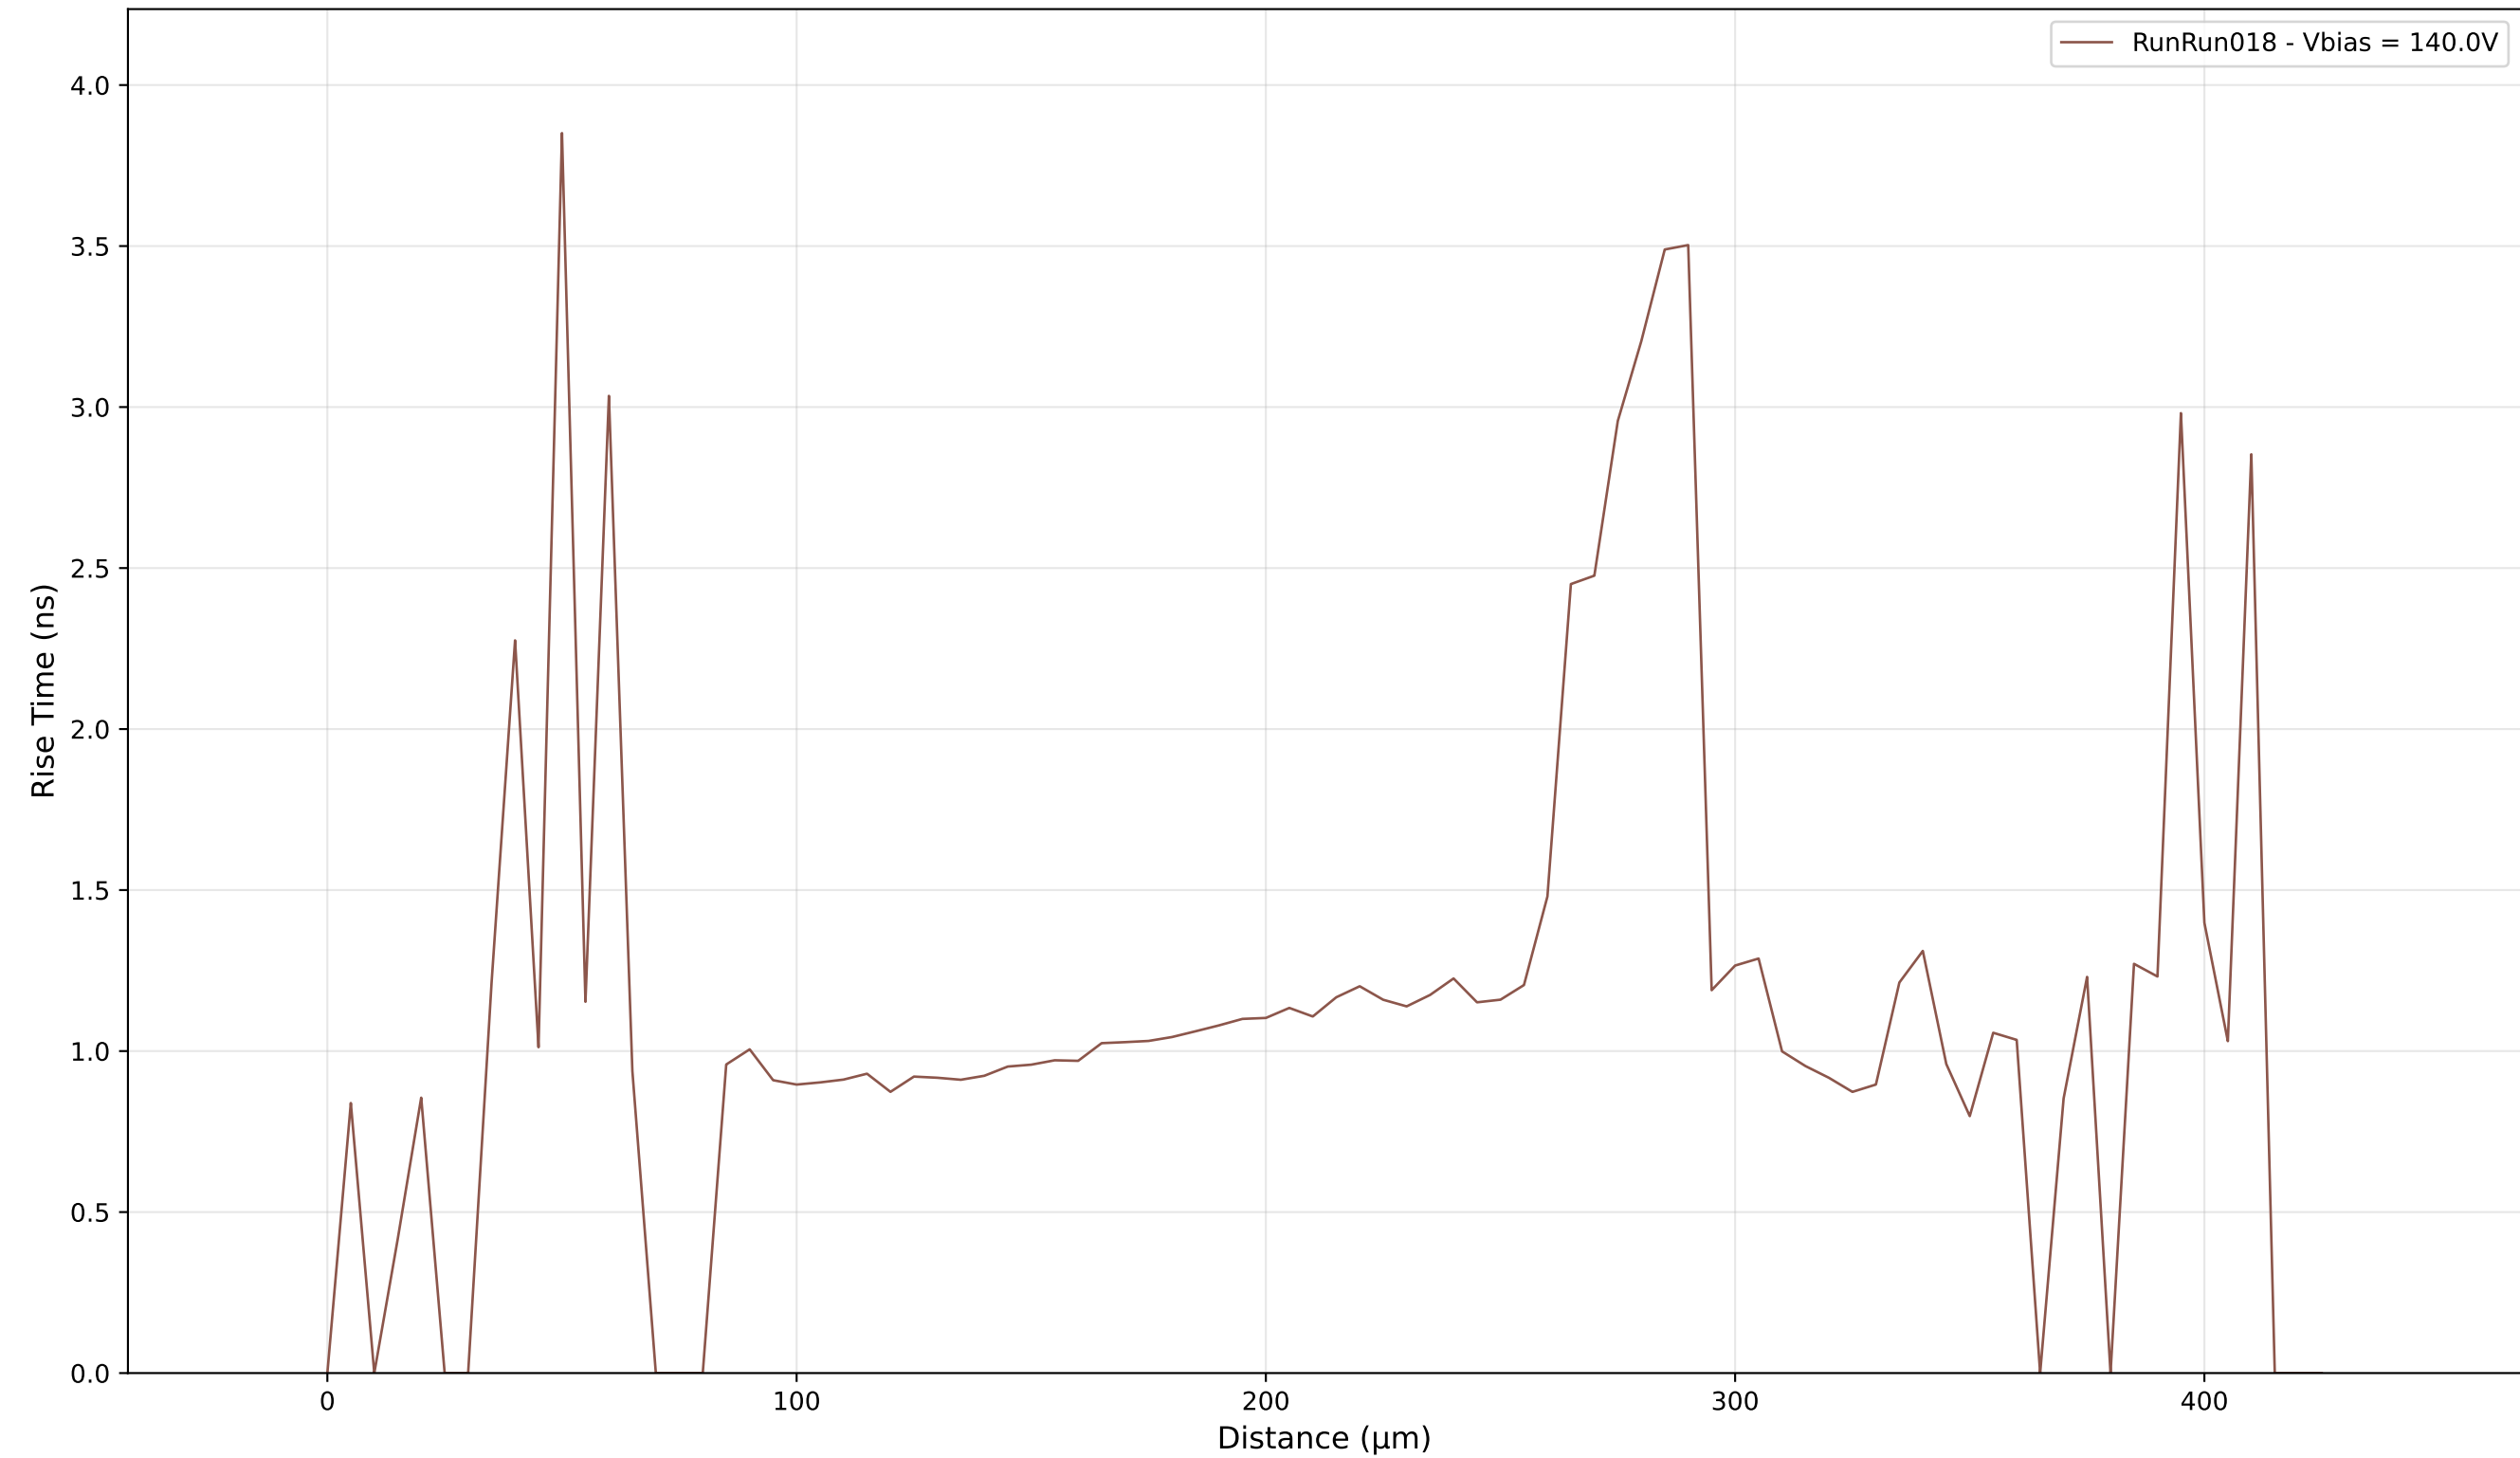


Amplitude

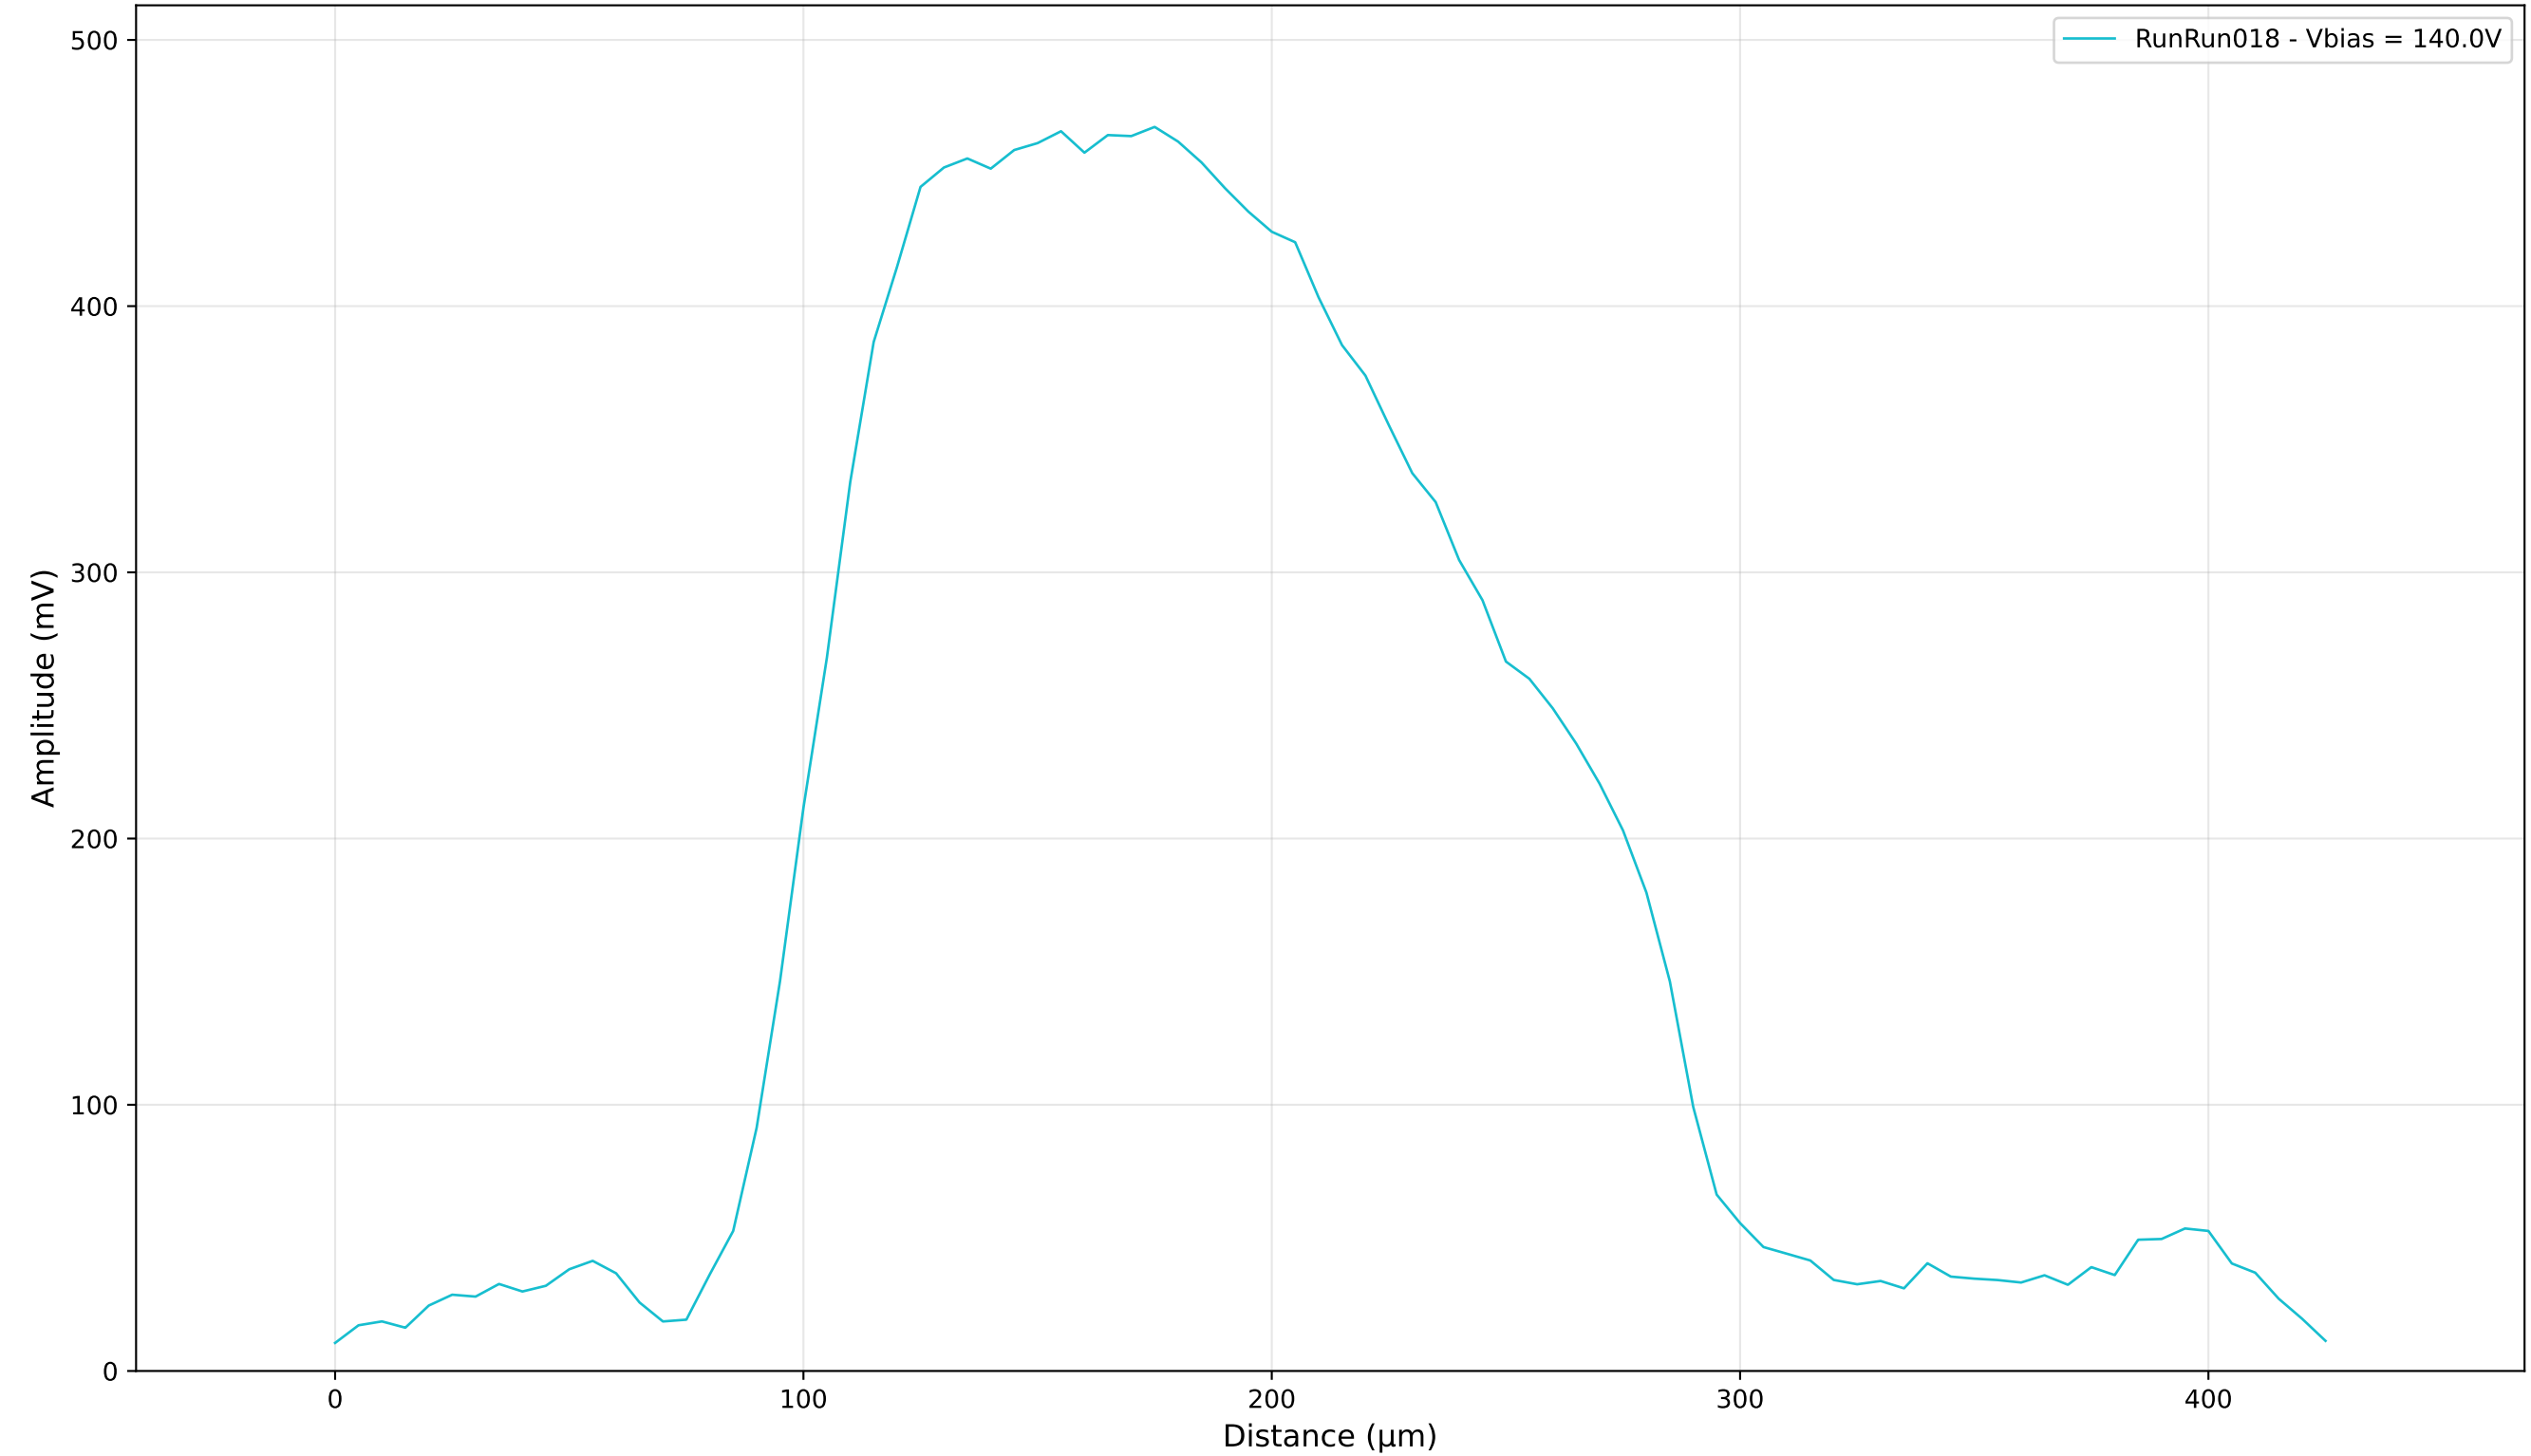


FWHM

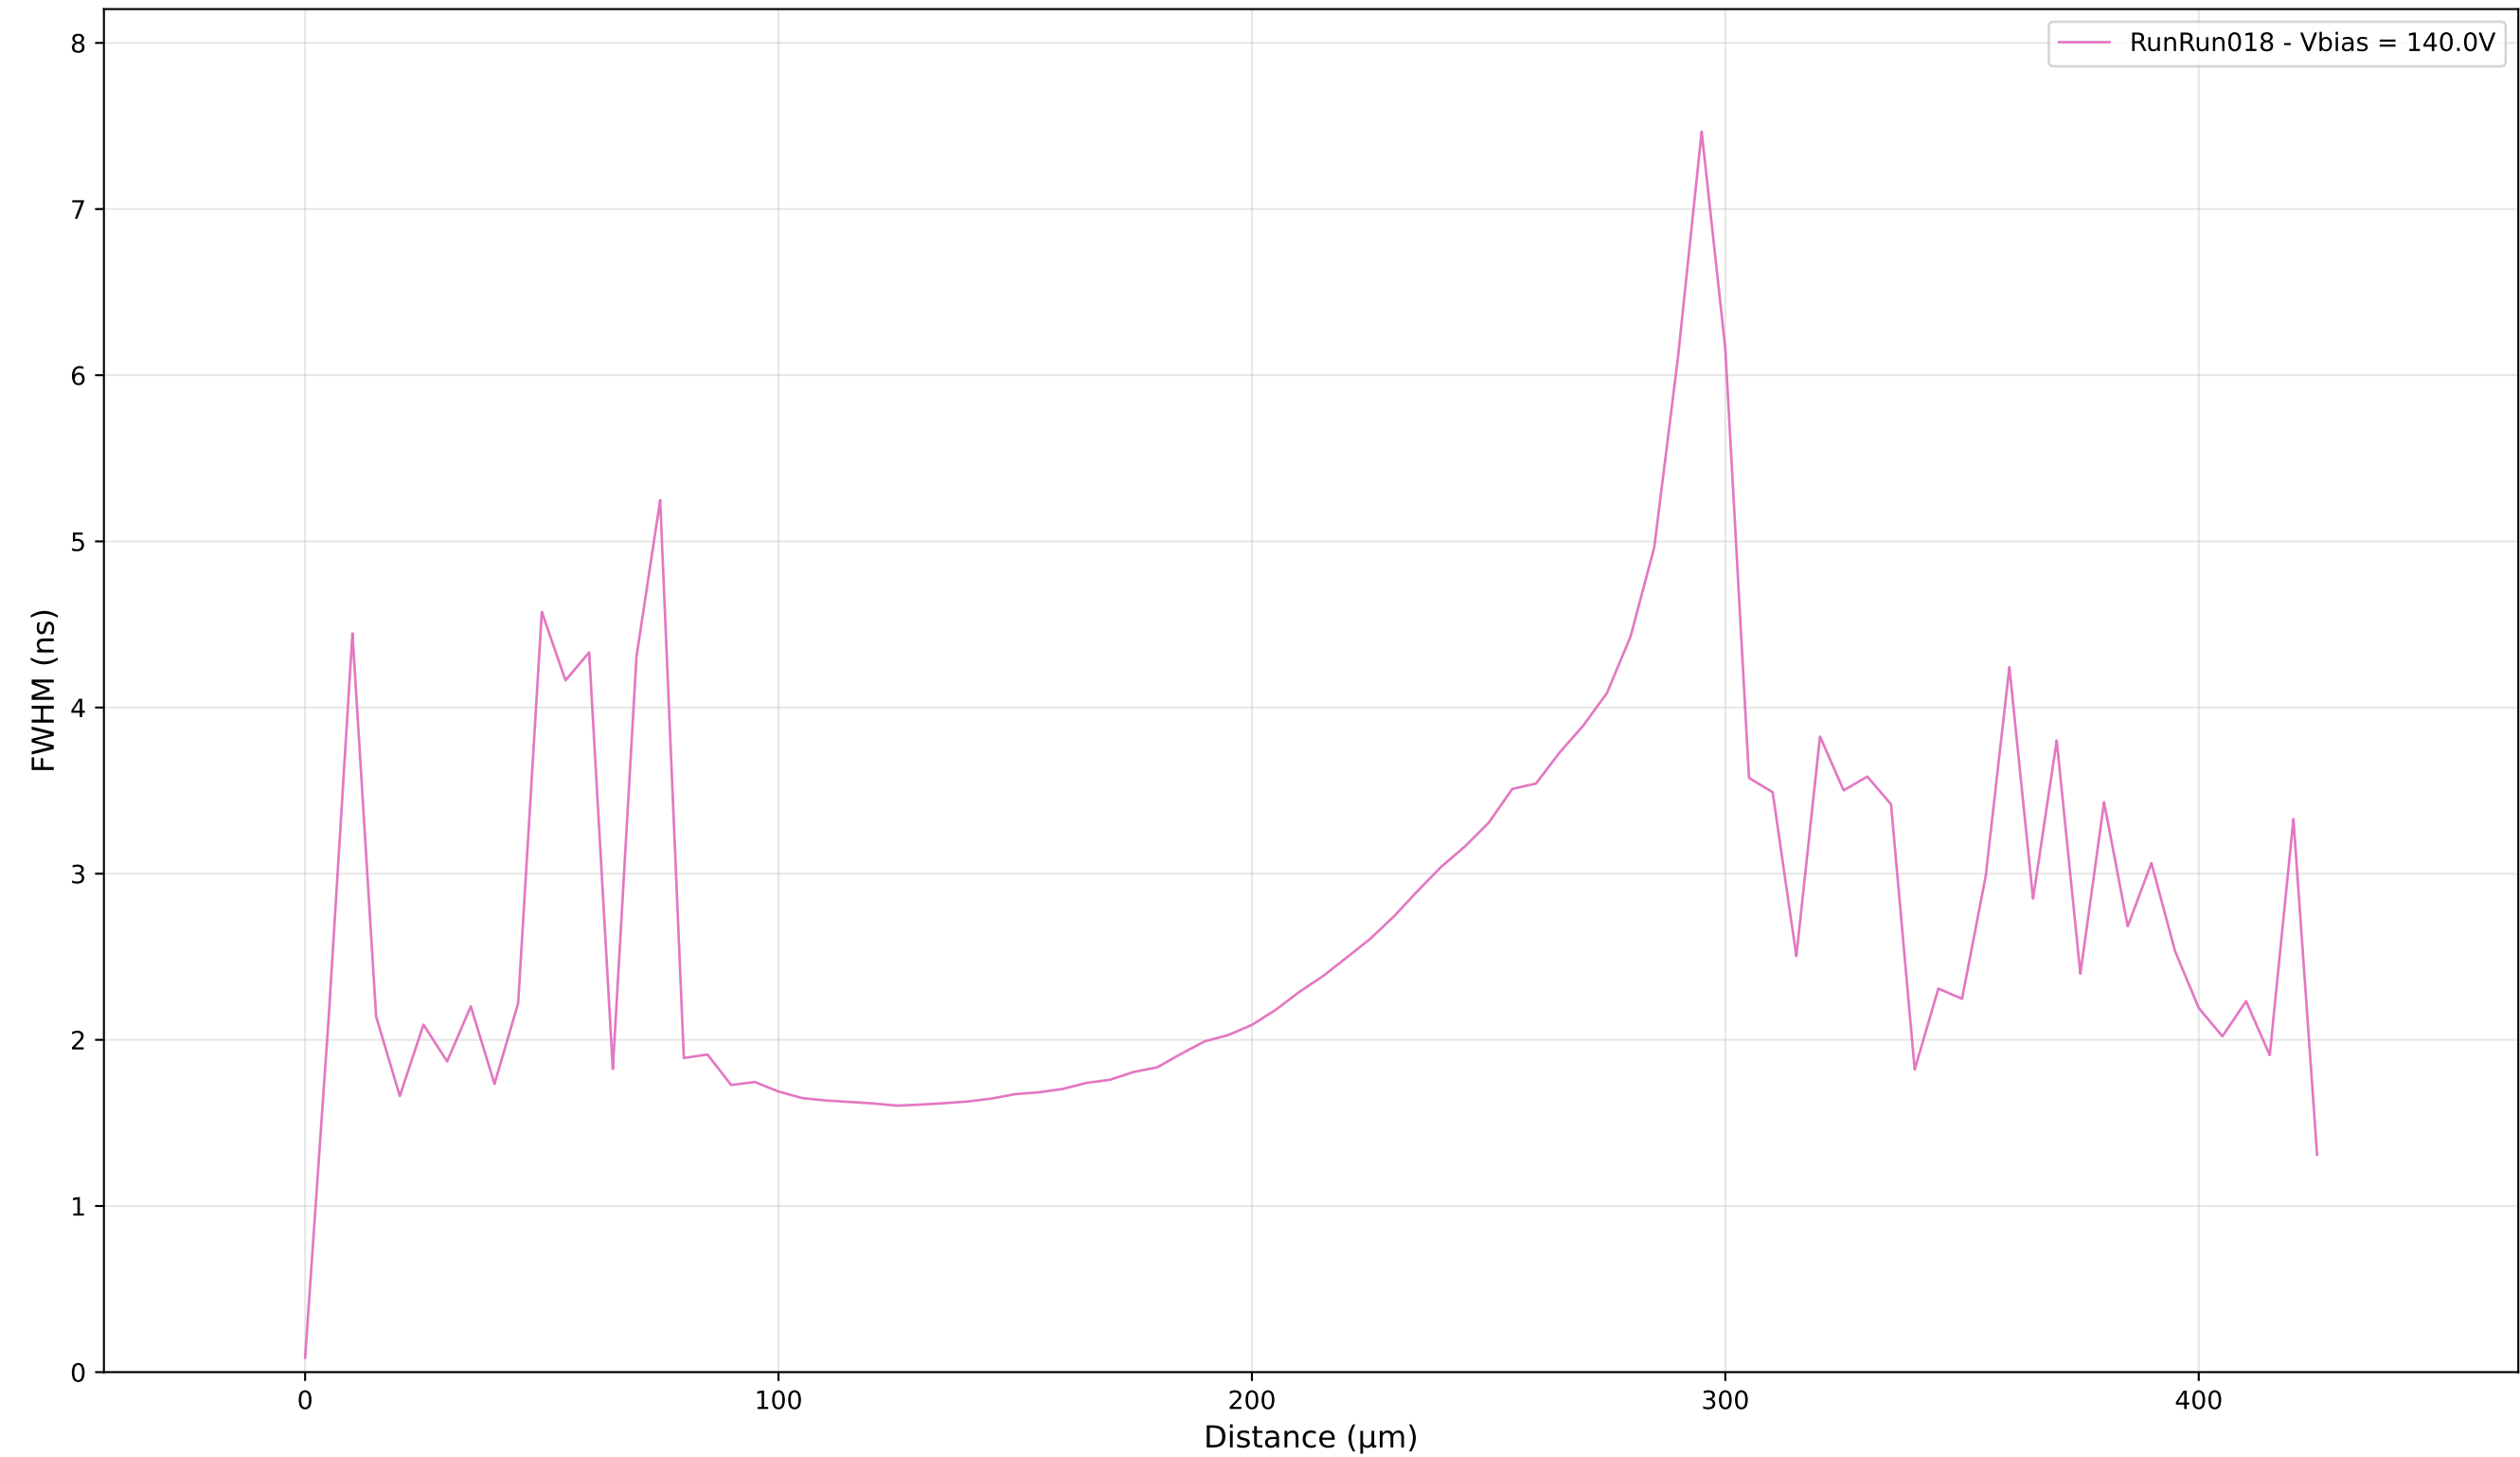


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 1.48 pC - Rise Time: 0.00 ns (N/A)

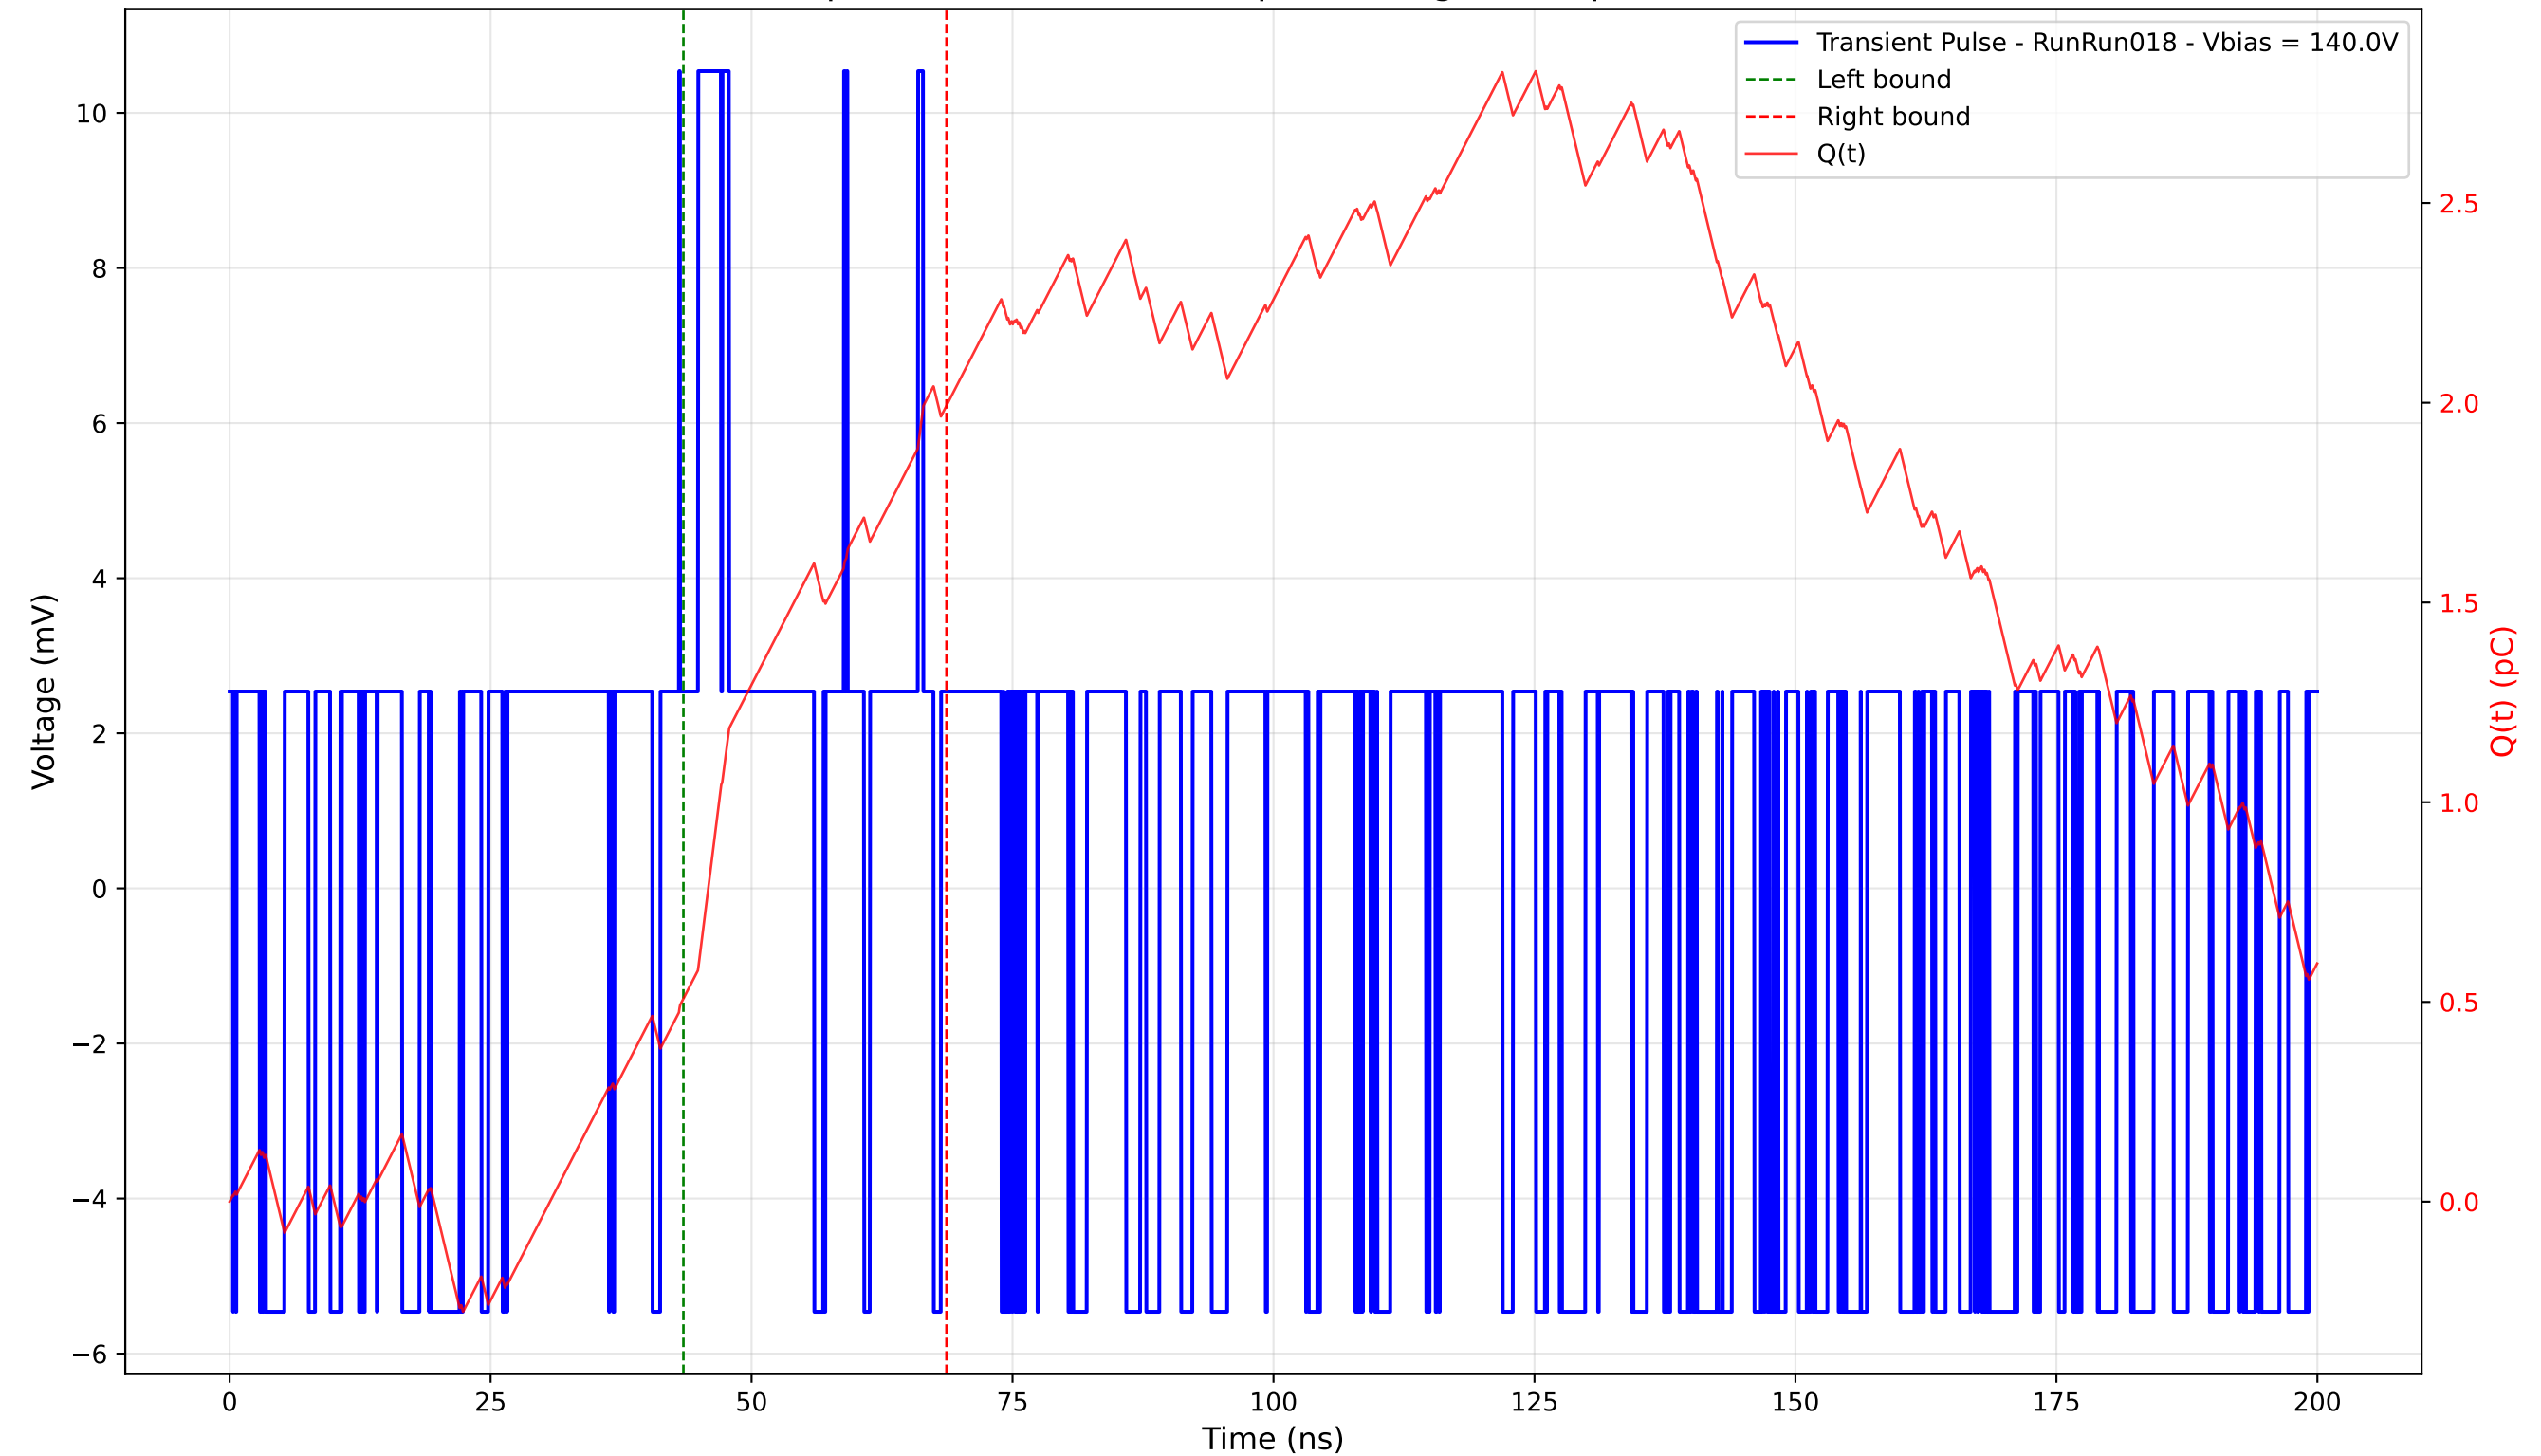


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 1.45 pC - Rise Time: 0.84 ns

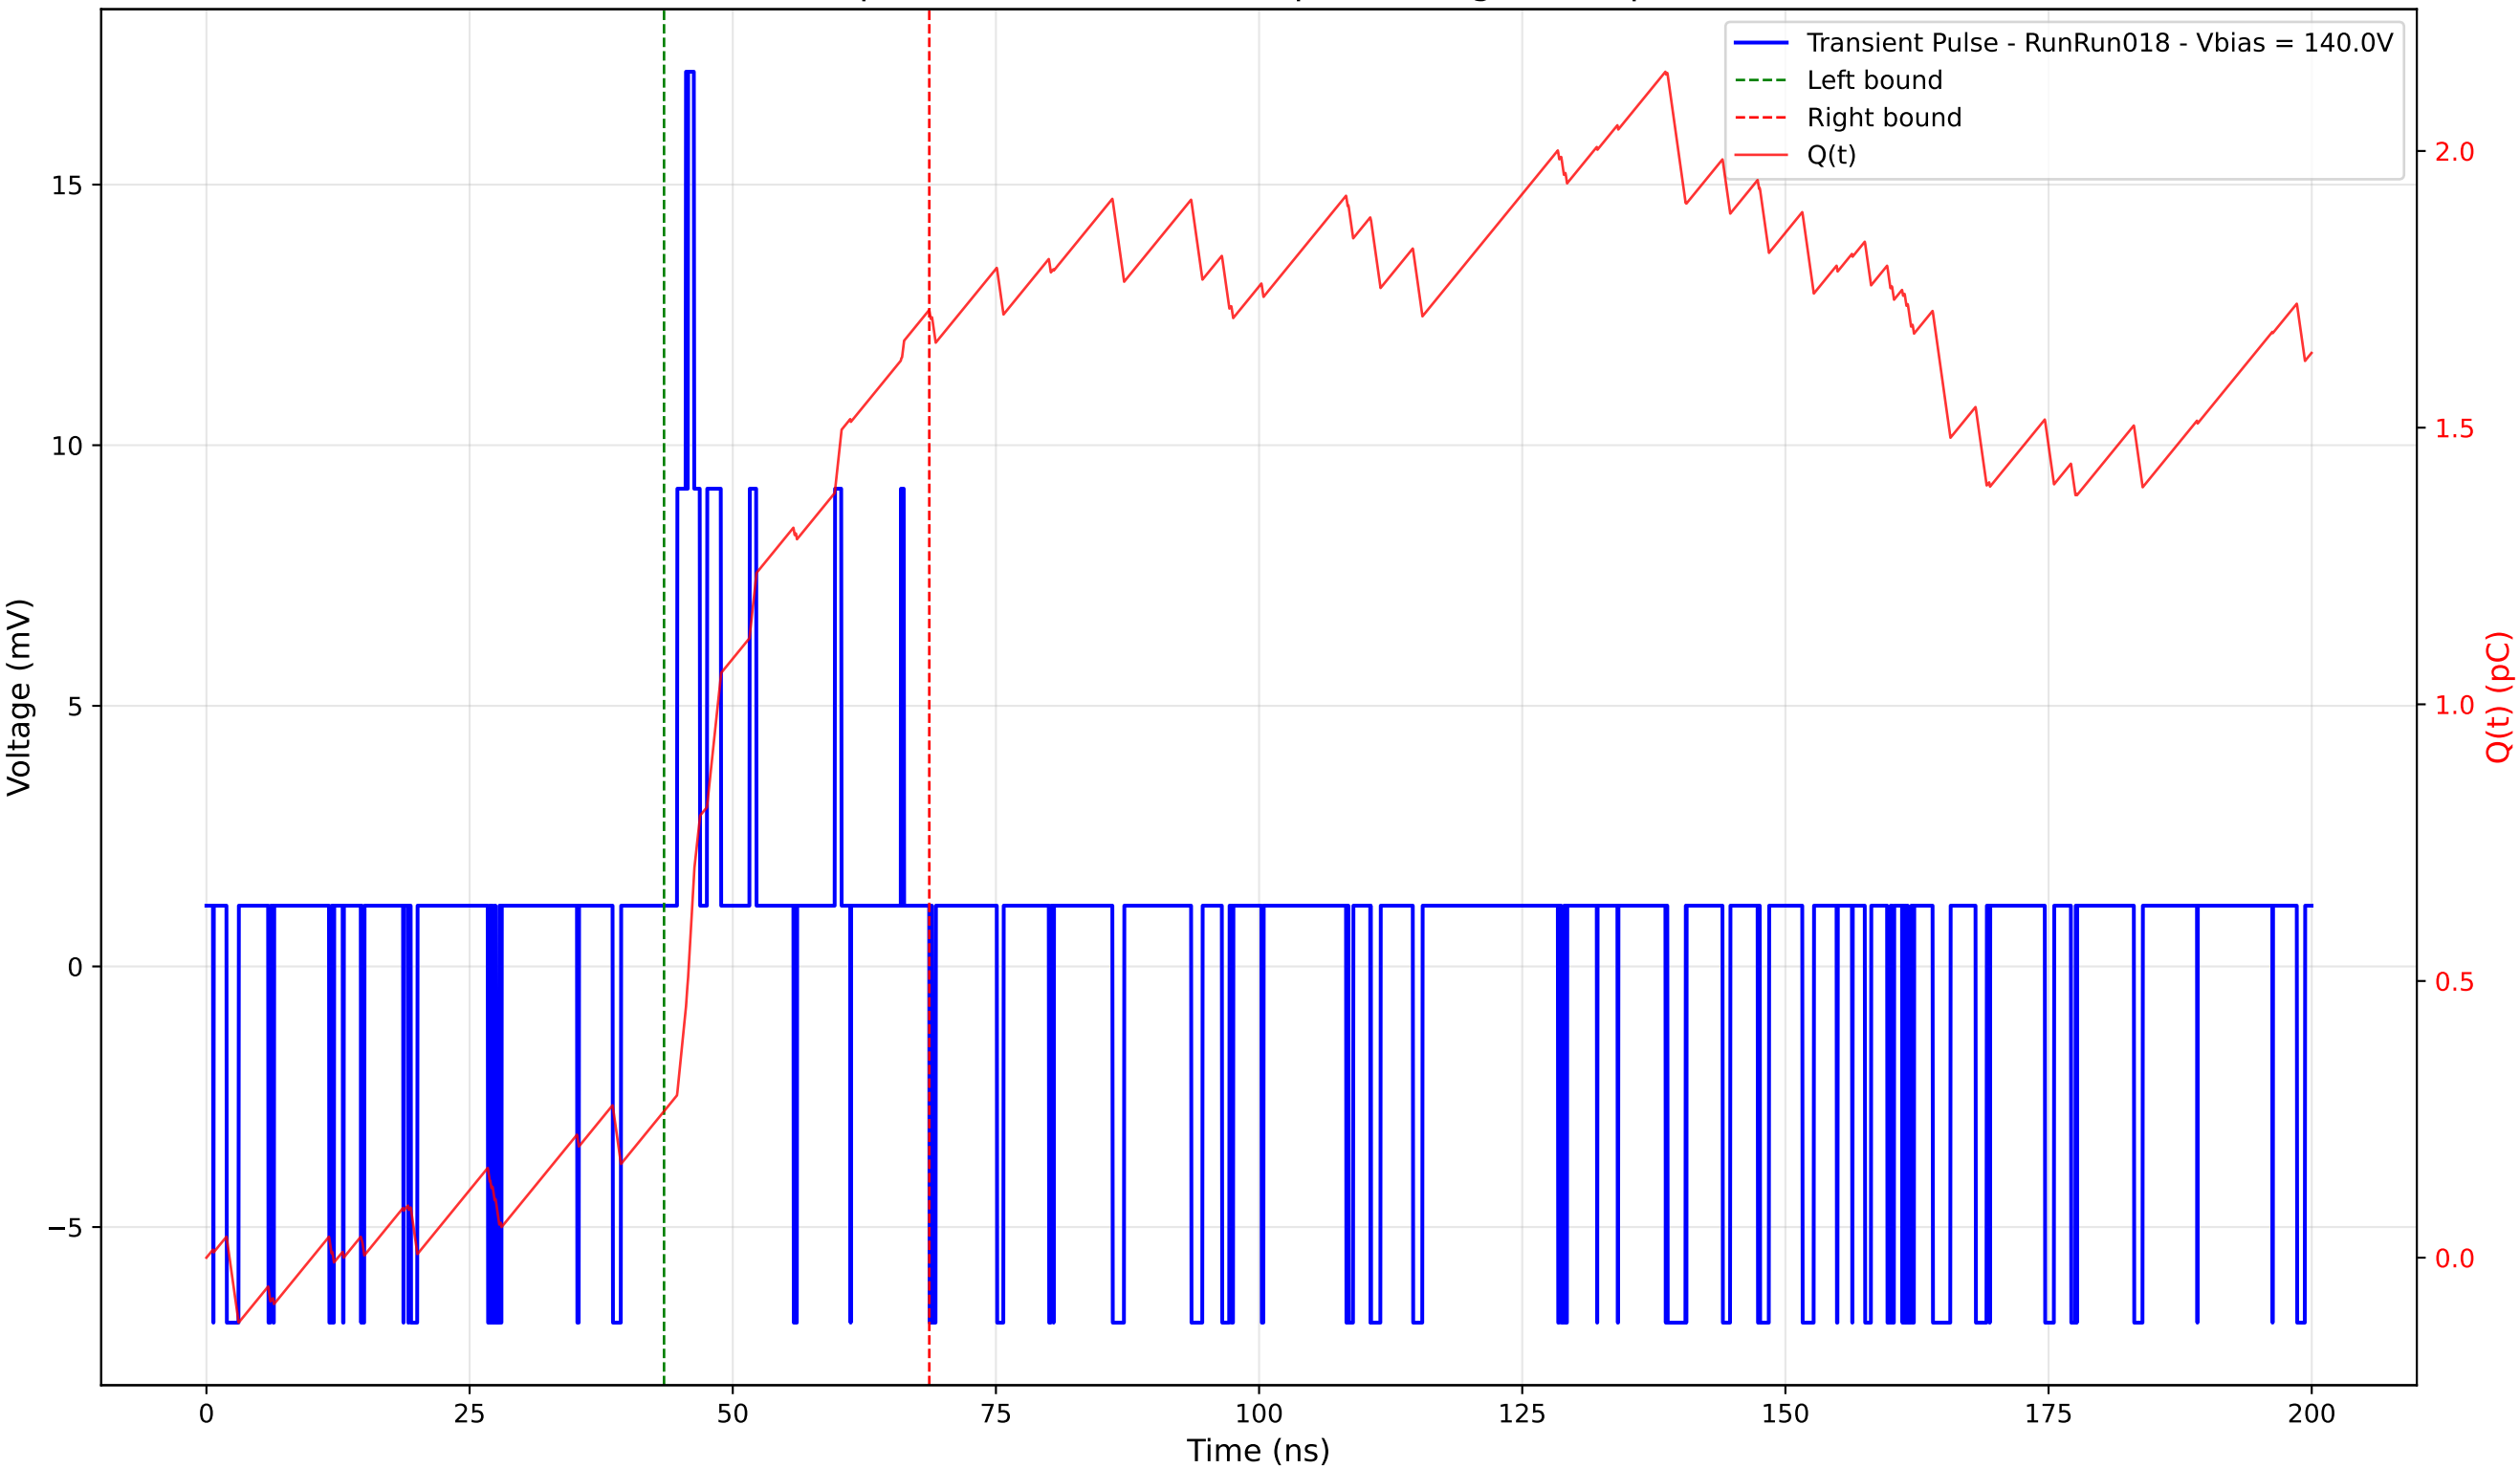


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 2.74 pC - Rise Time: 0.00 ns (N/A)

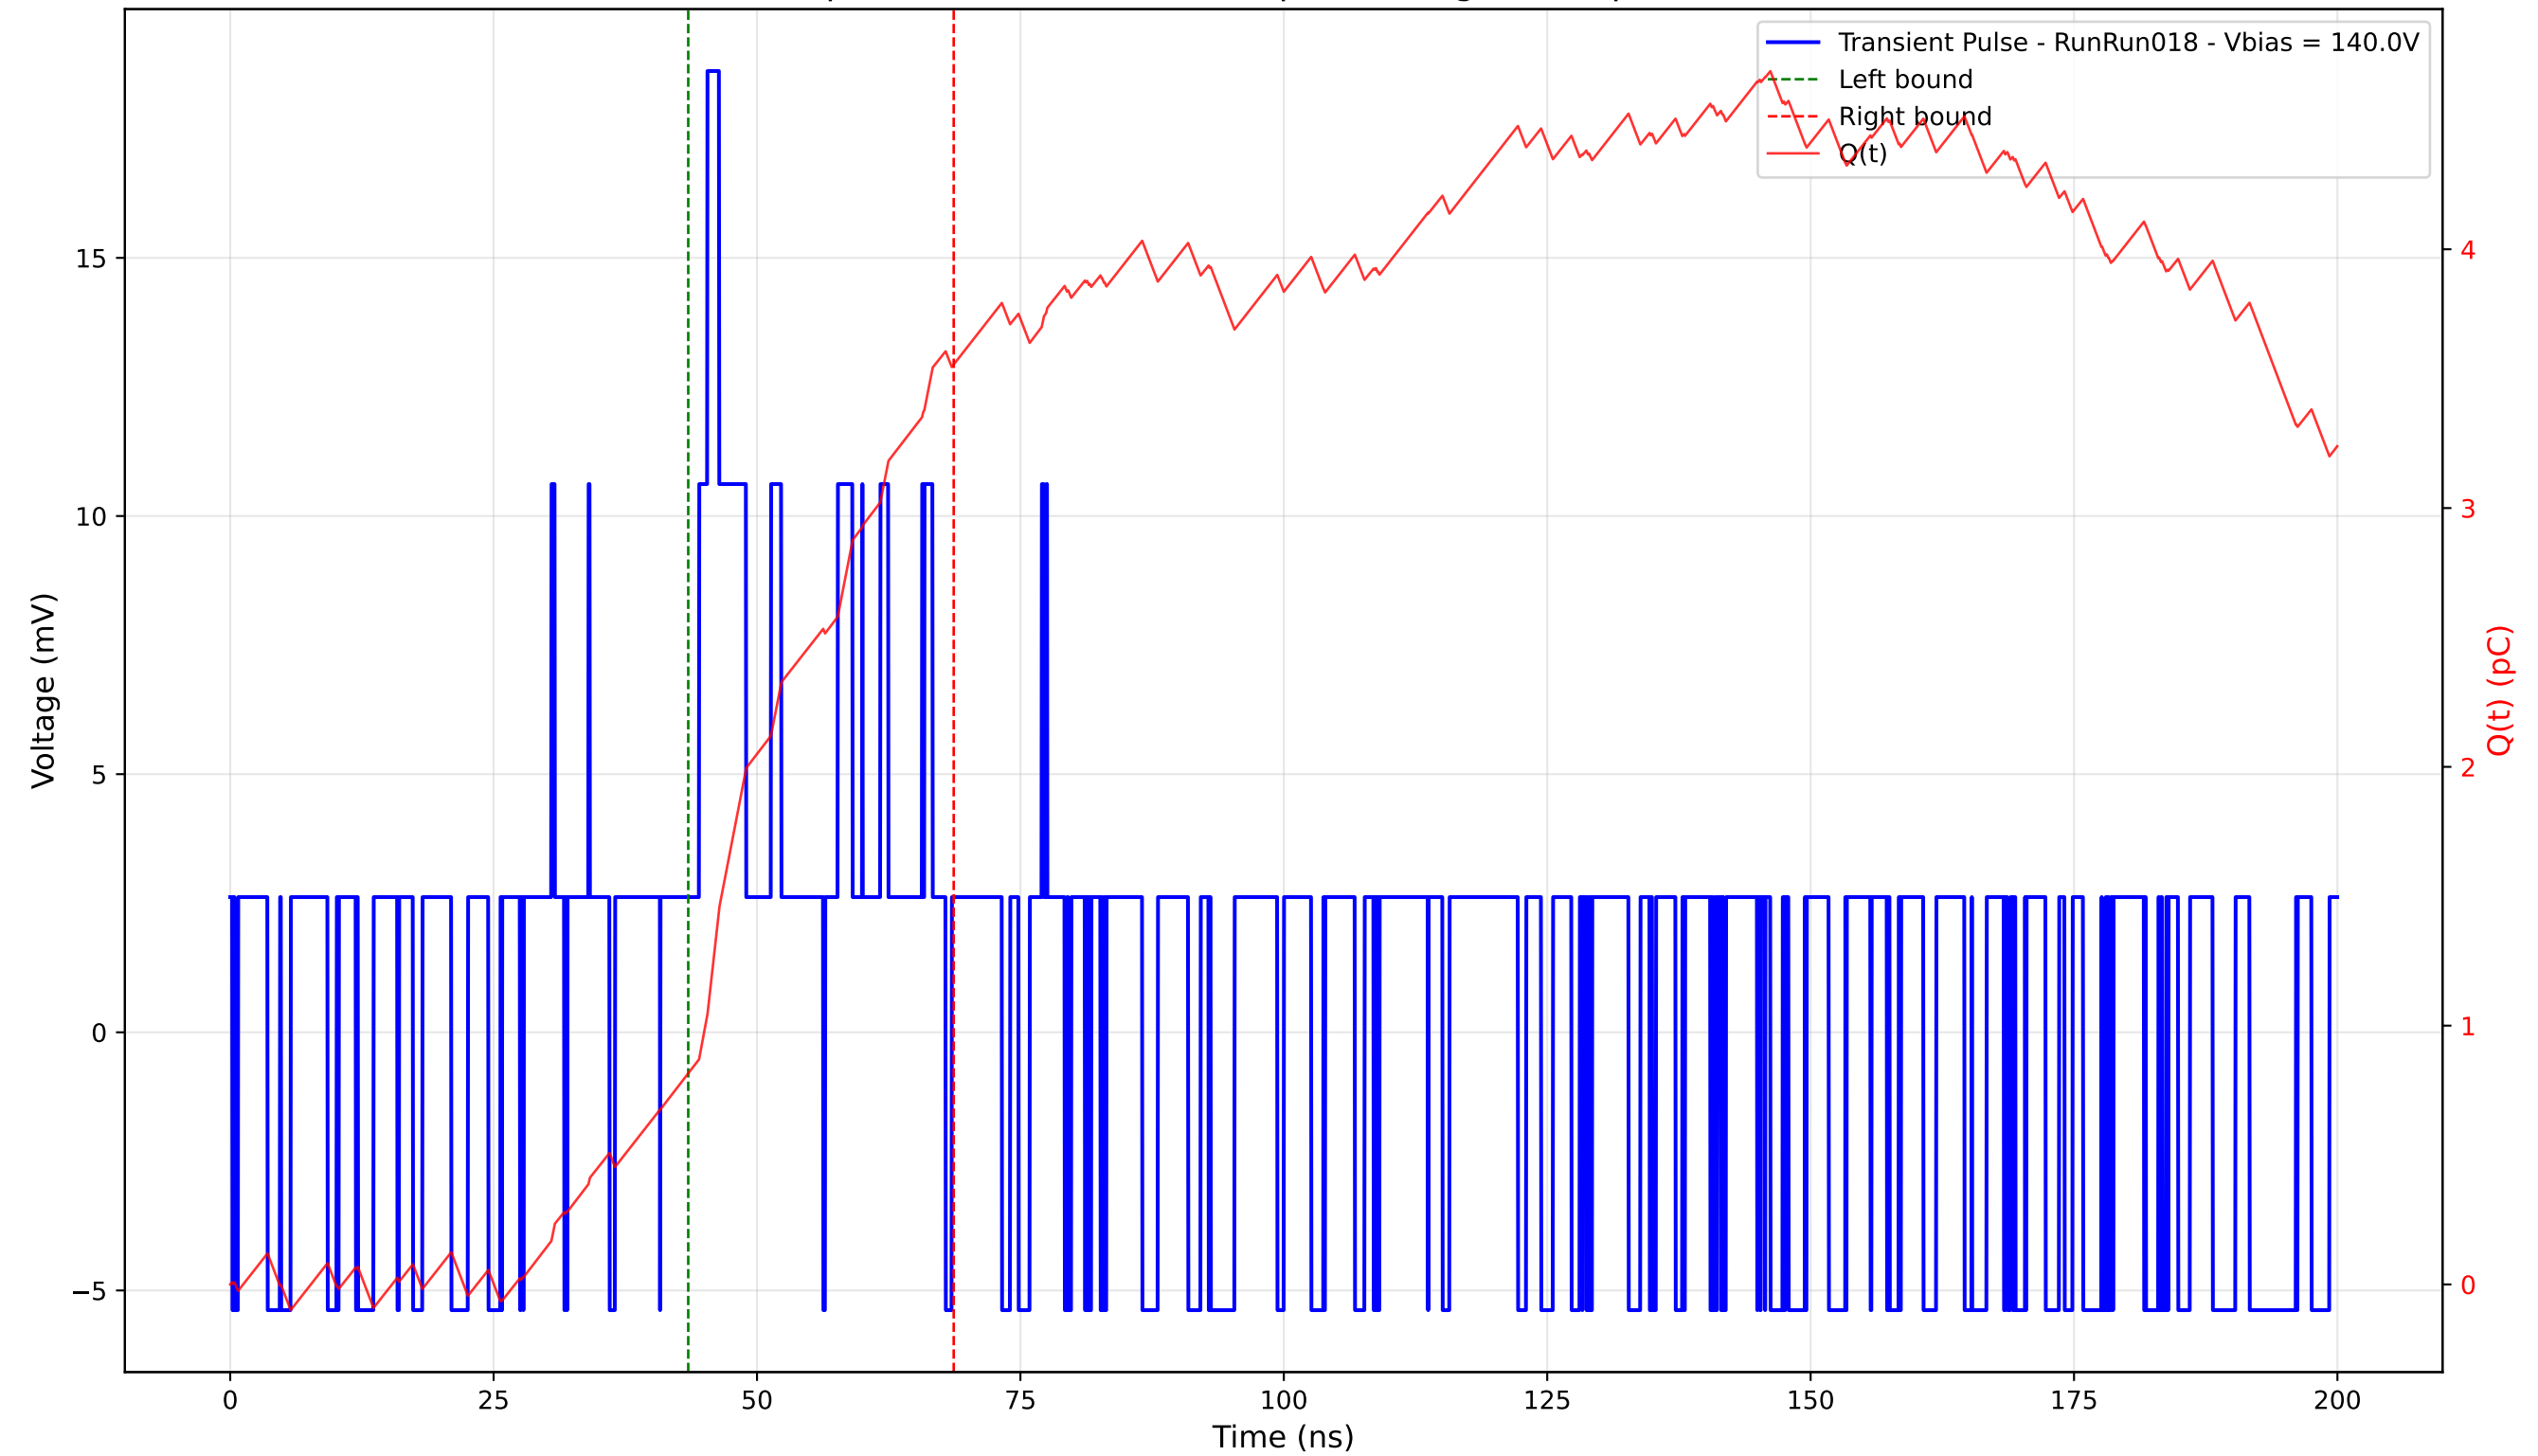


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 0.71 pC - Rise Time: 0.42 ns

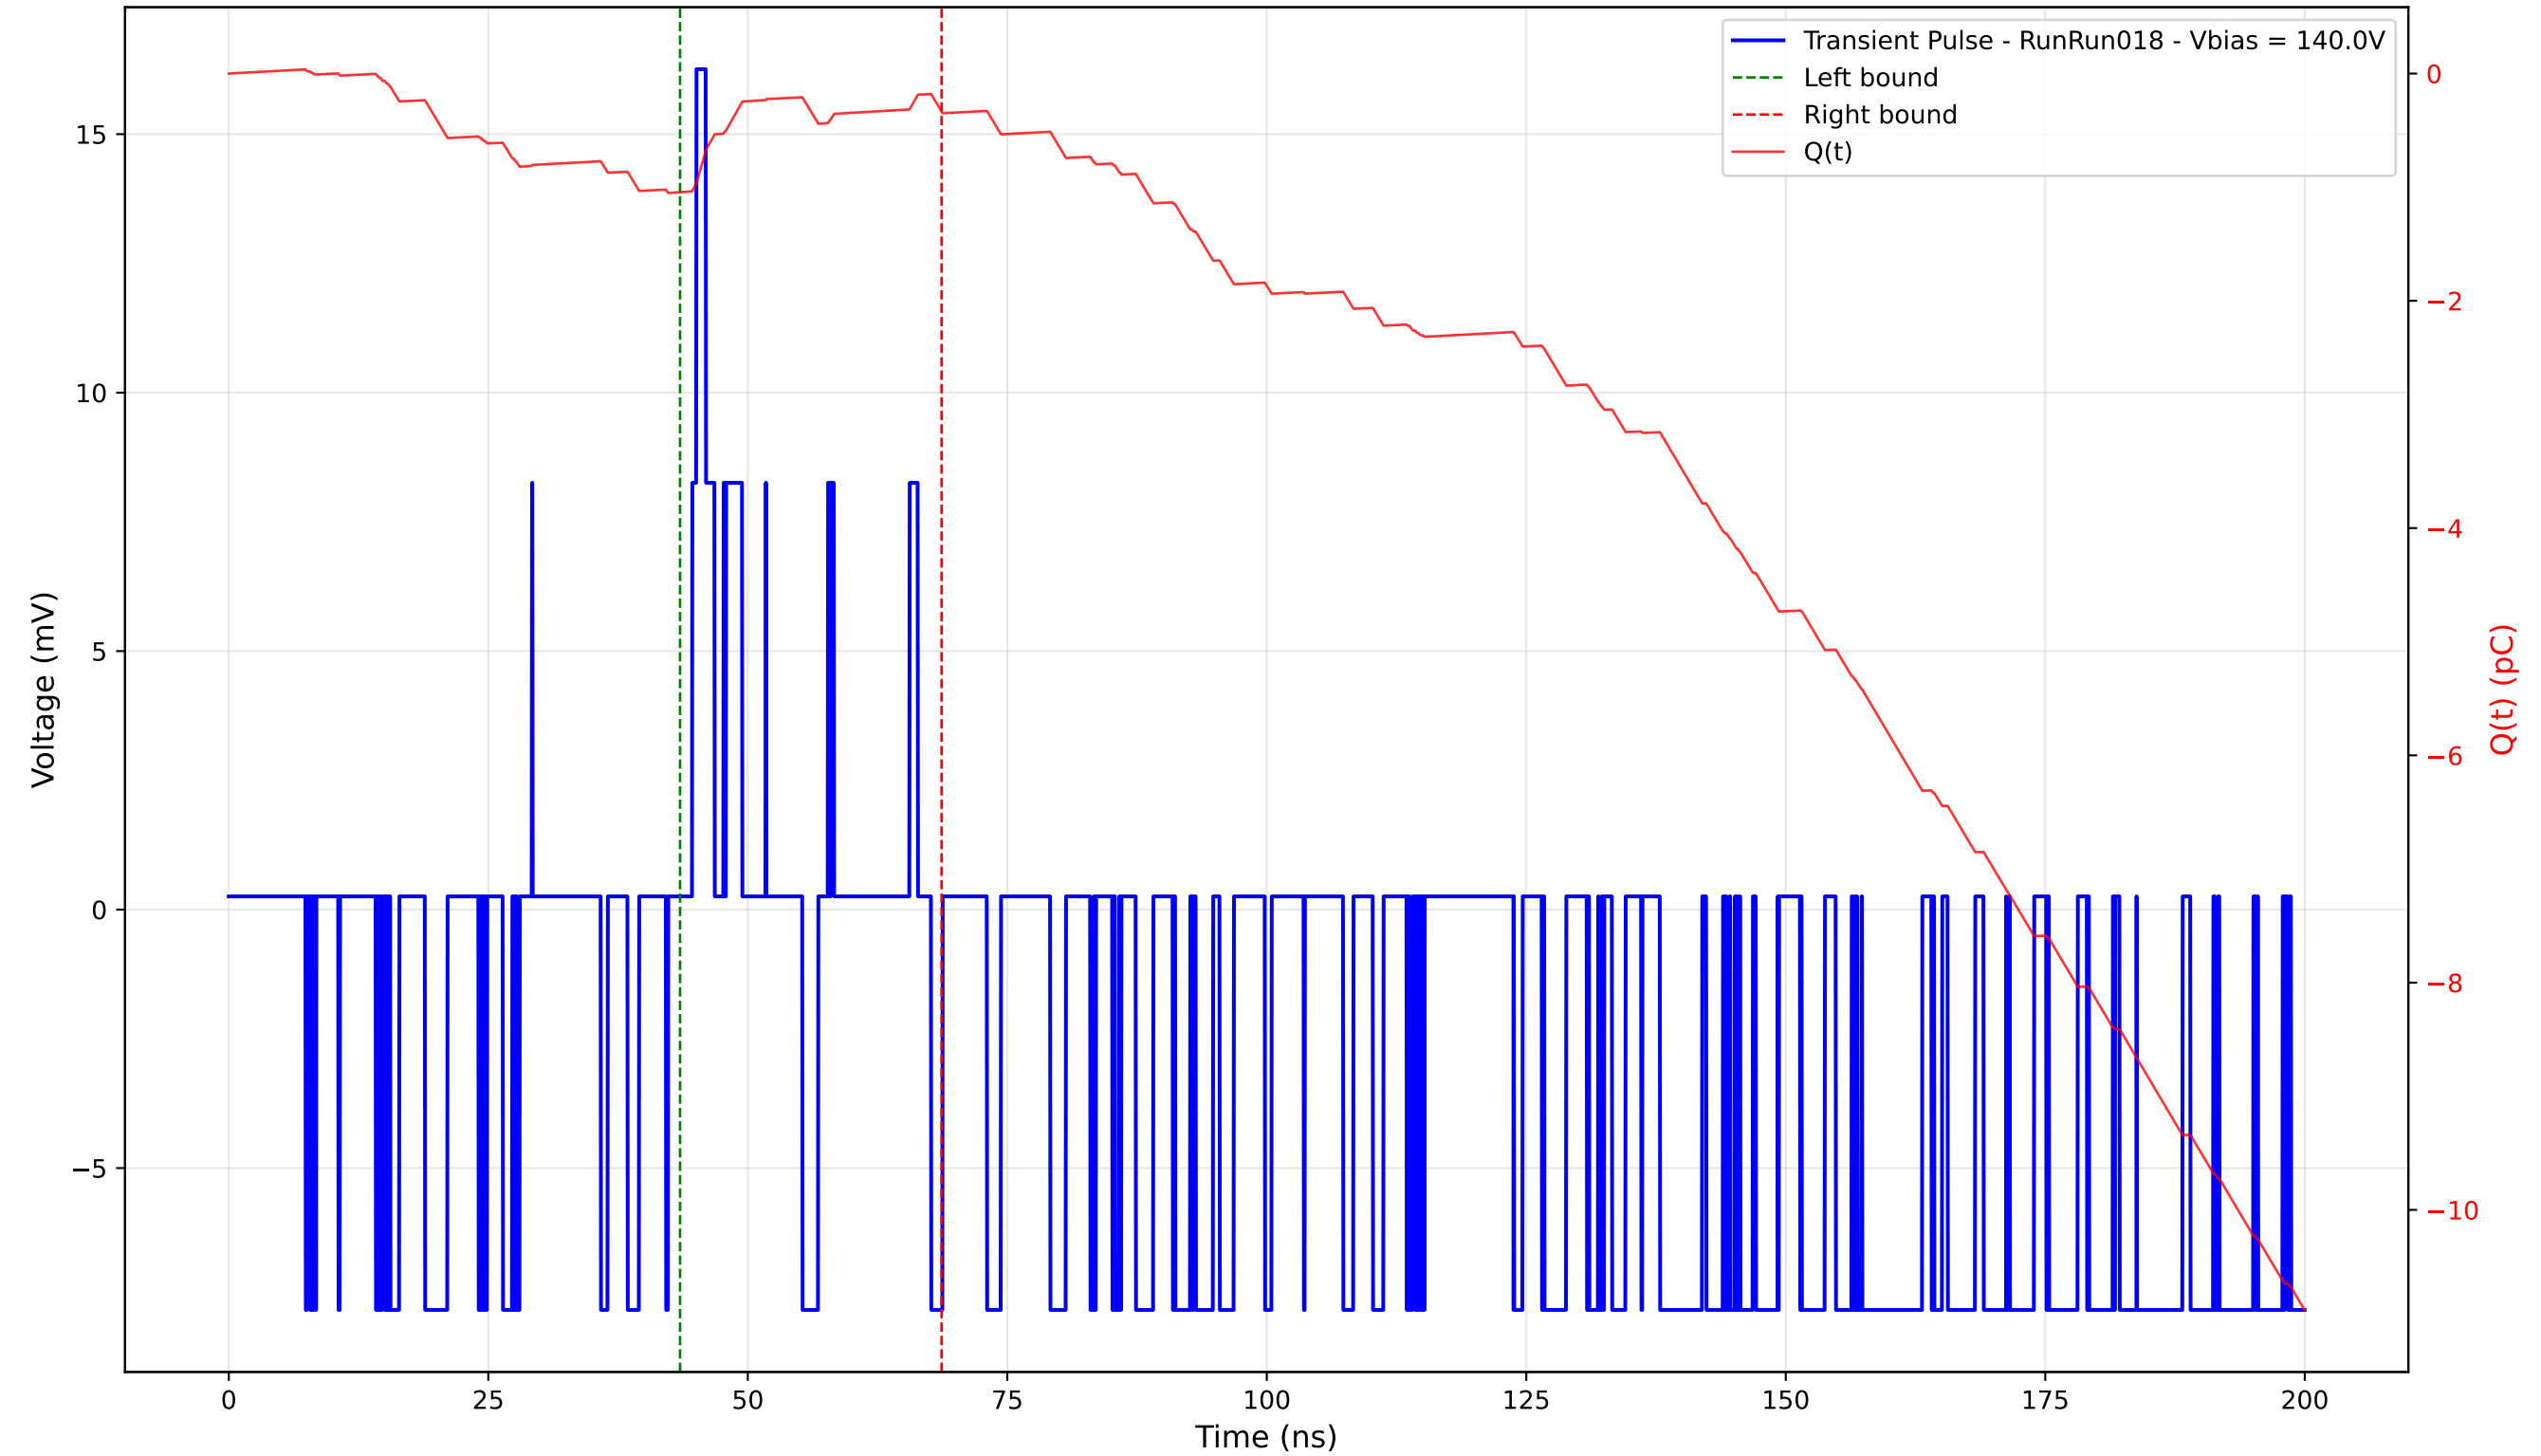


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 1.95 pC - Rise Time: 0.86 ns

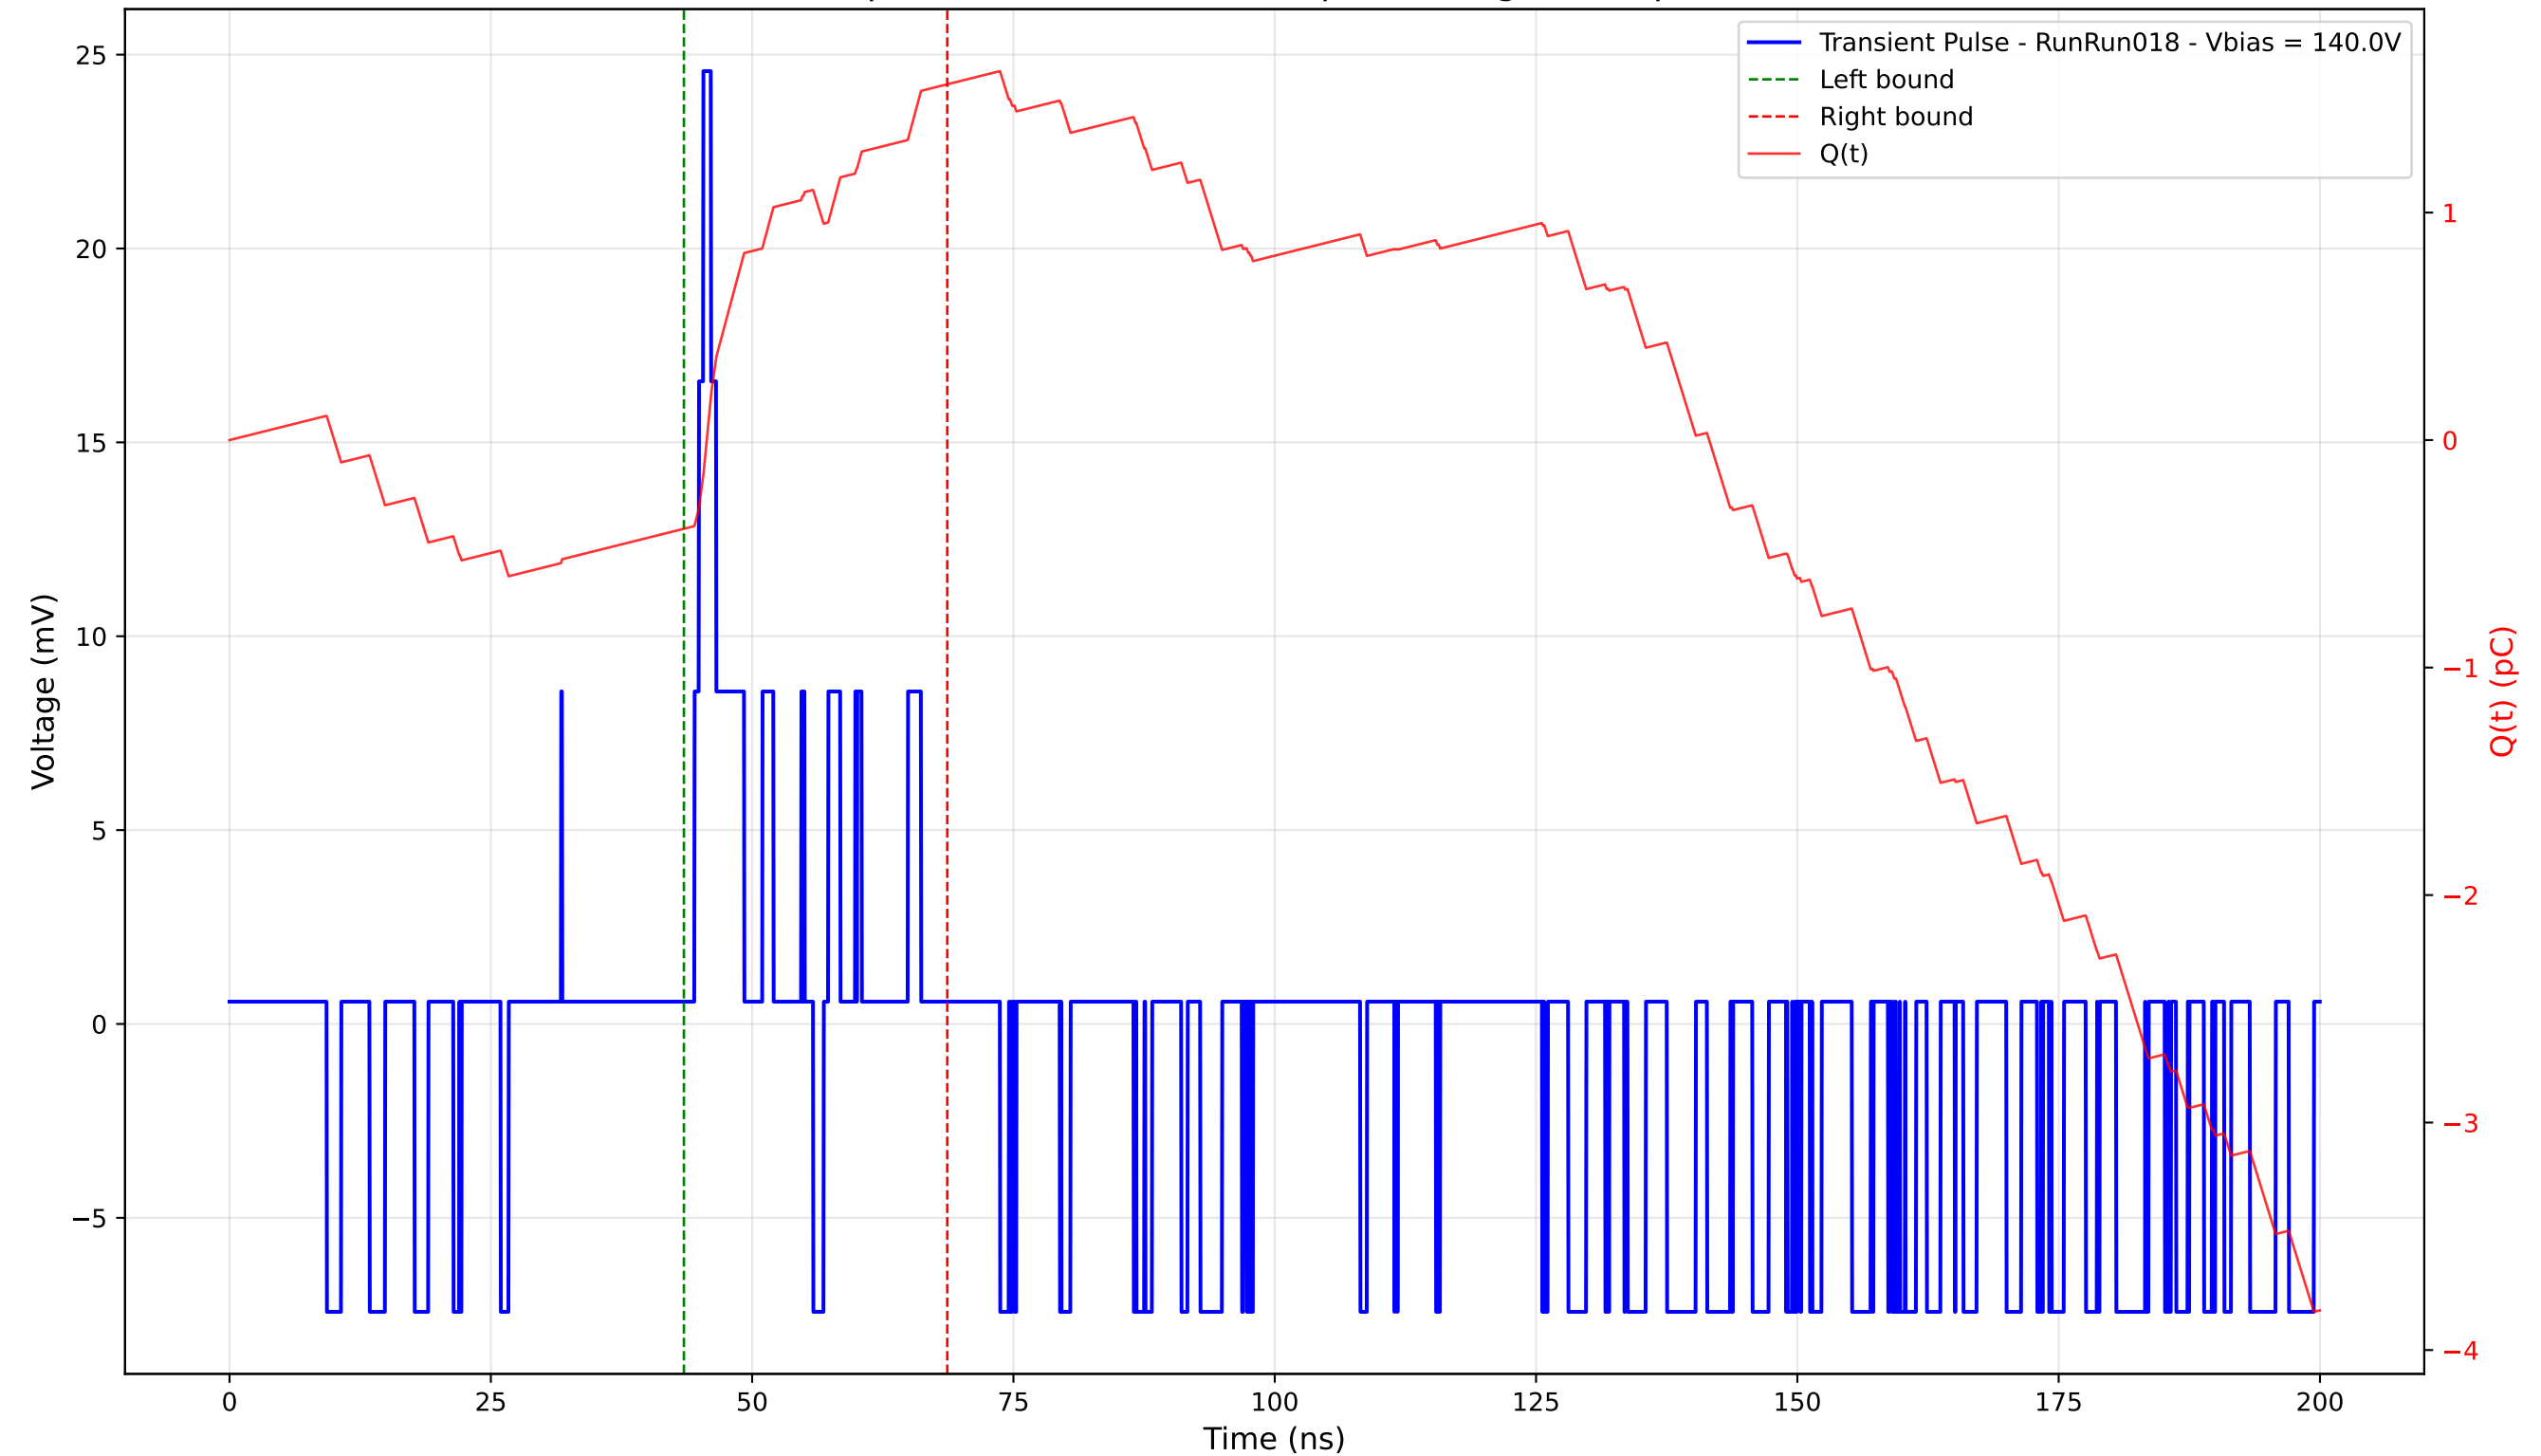


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.31 pC - Rise Time: 0.00 ns (N/A)

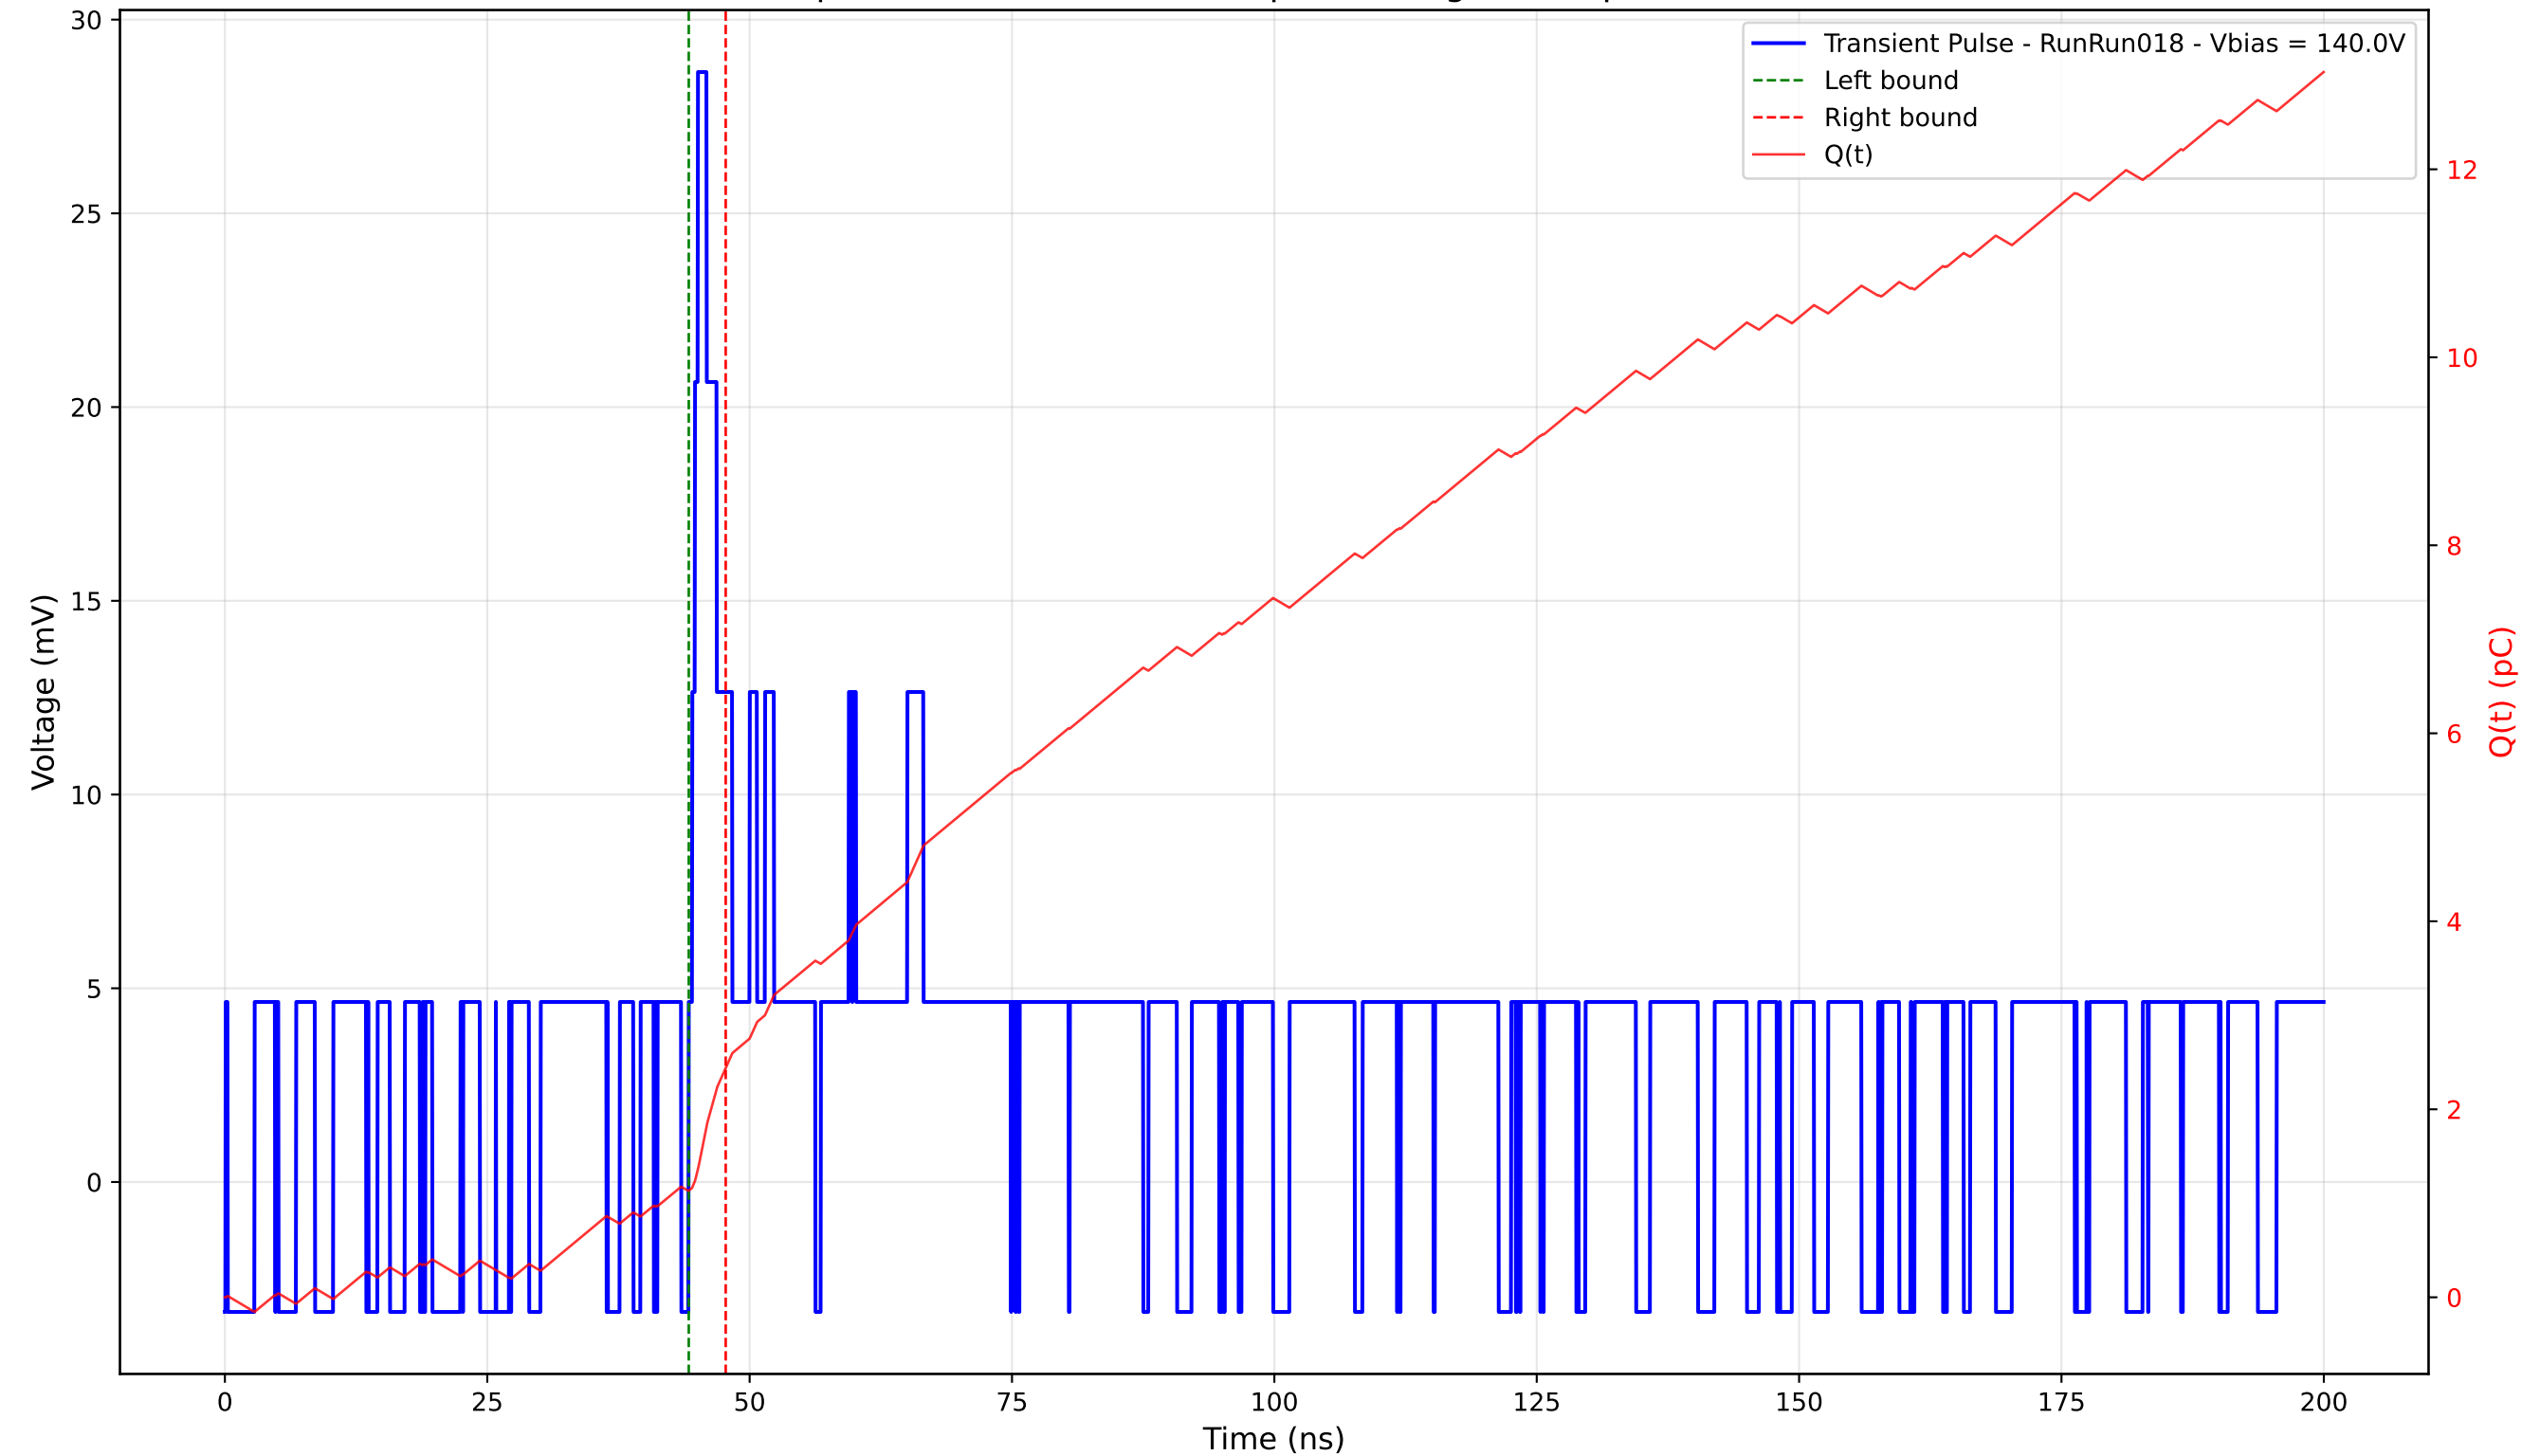


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.26 pC - Rise Time: 0.00 ns (N/A)

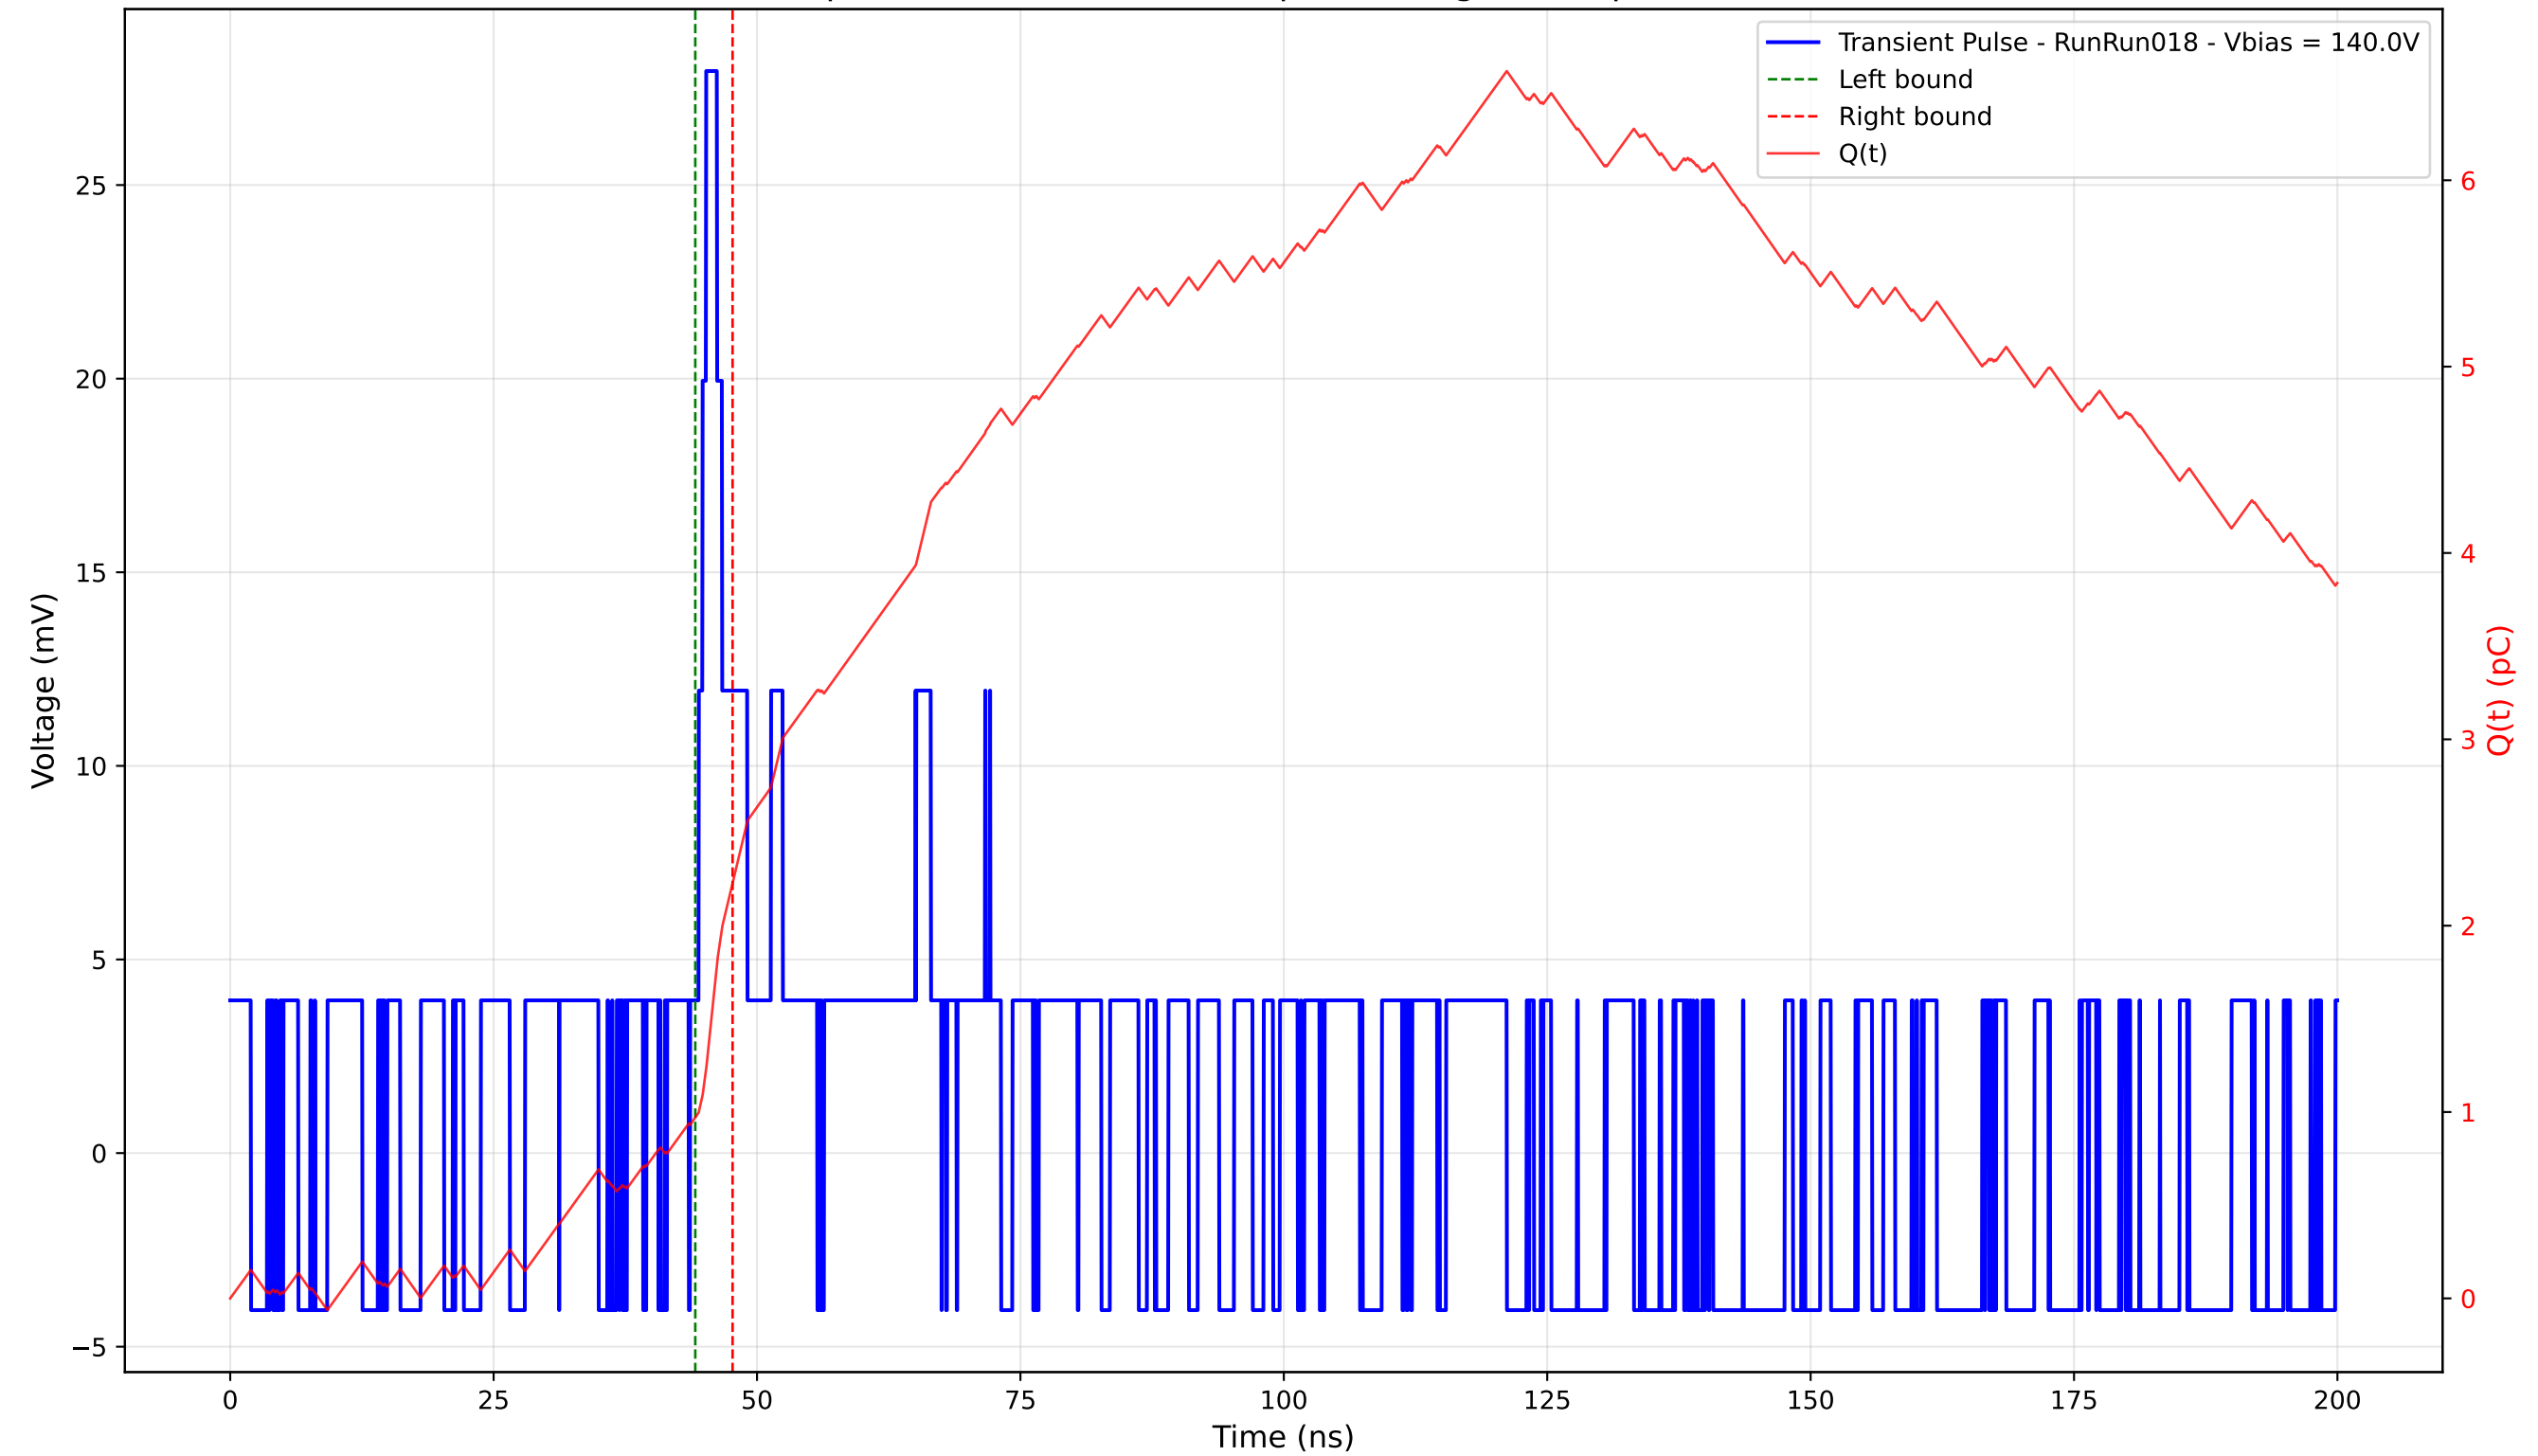


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.62 pC - Rise Time: 1.21 ns

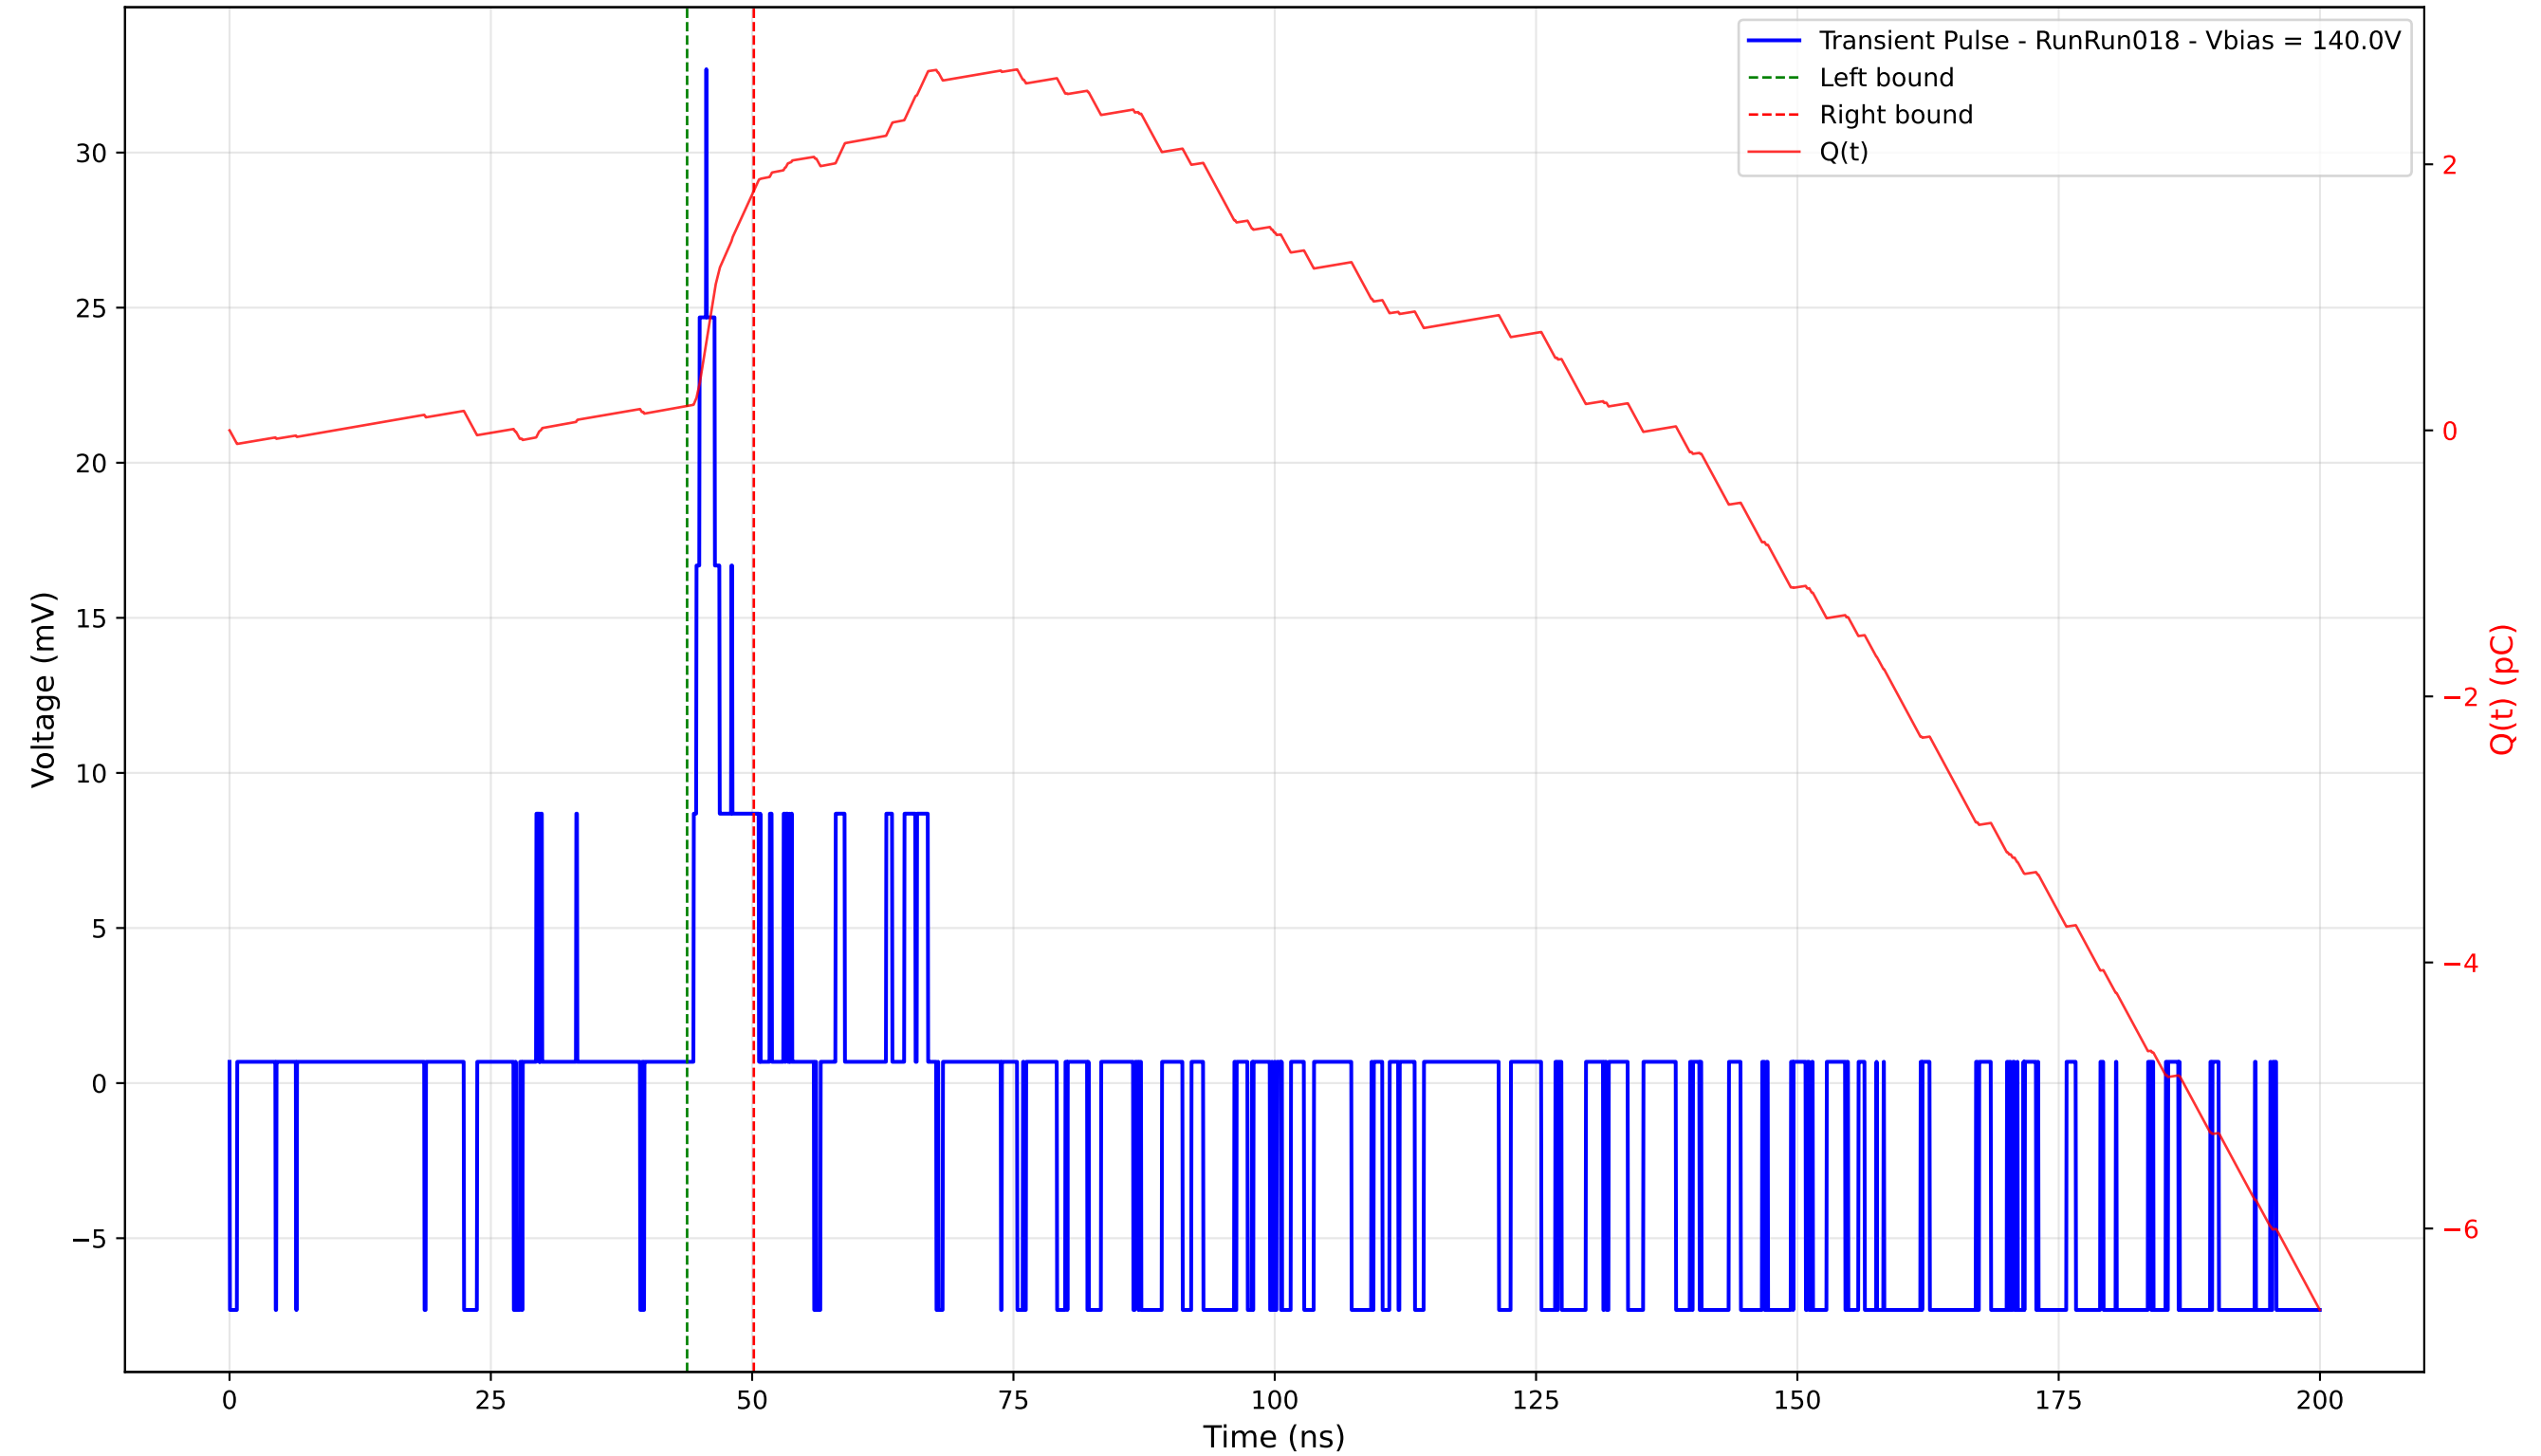


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.99 pC - Rise Time: 2.28 ns

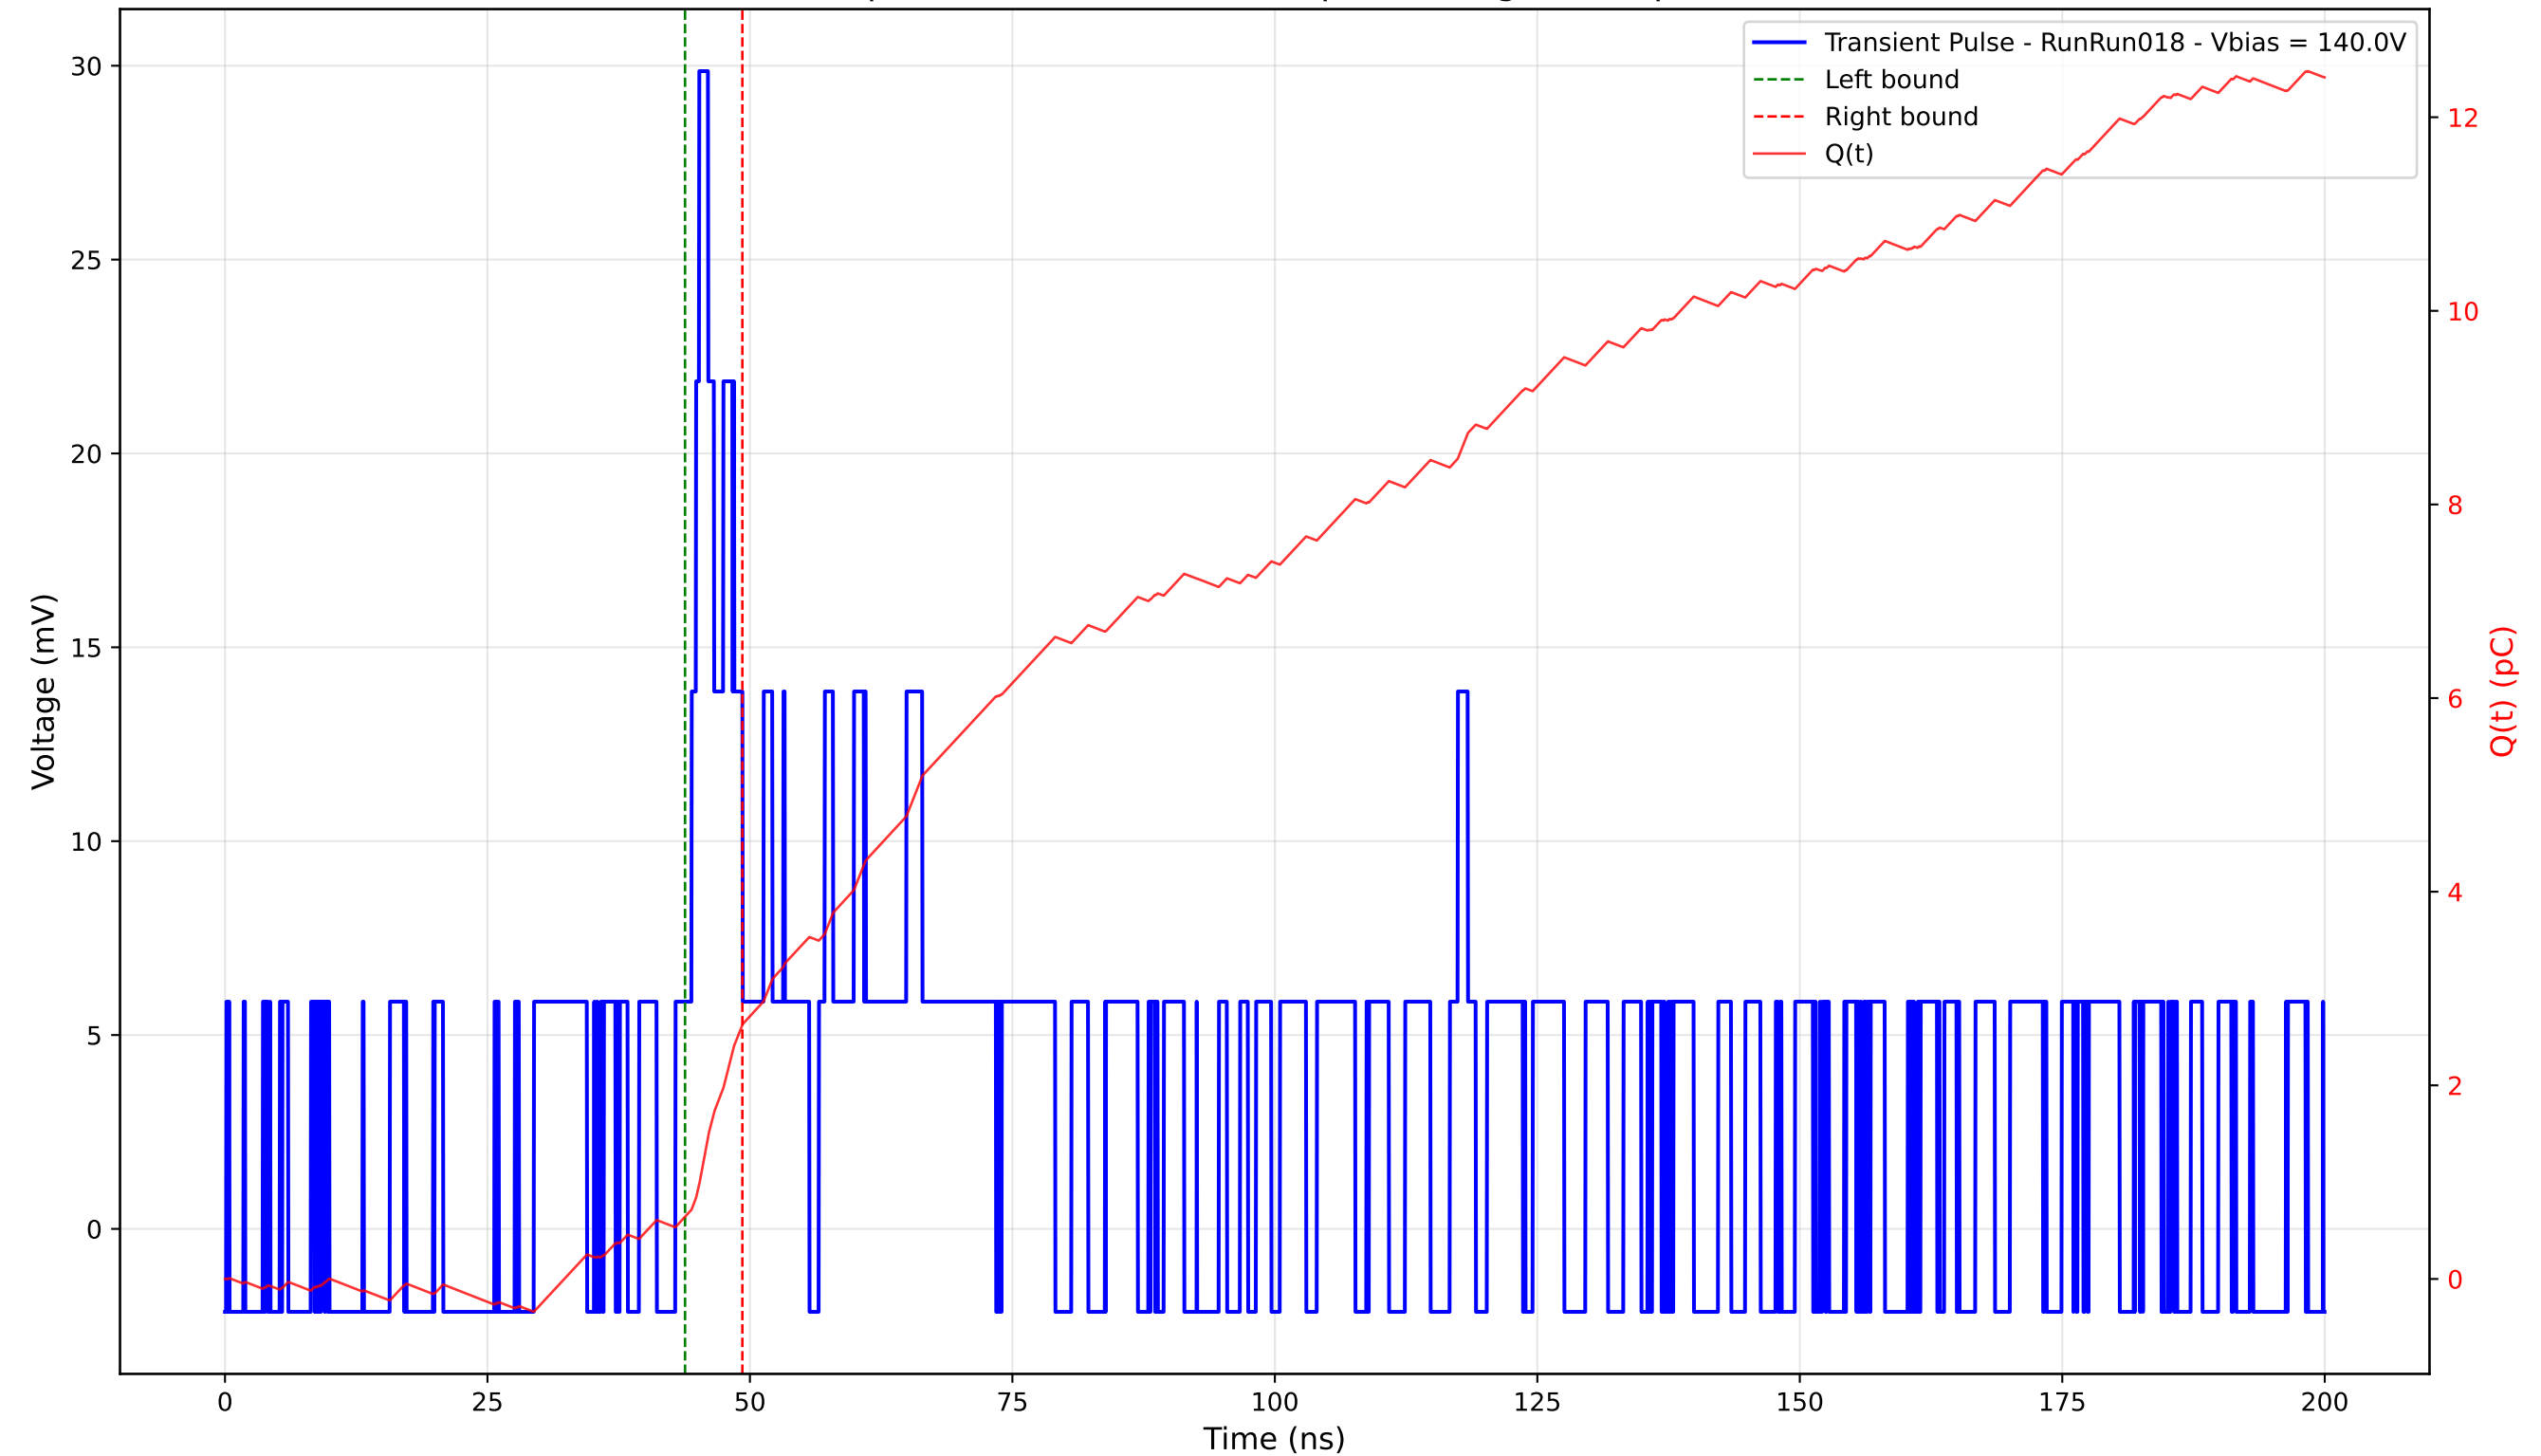


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 5.60 pC - Rise Time: 1.01 ns

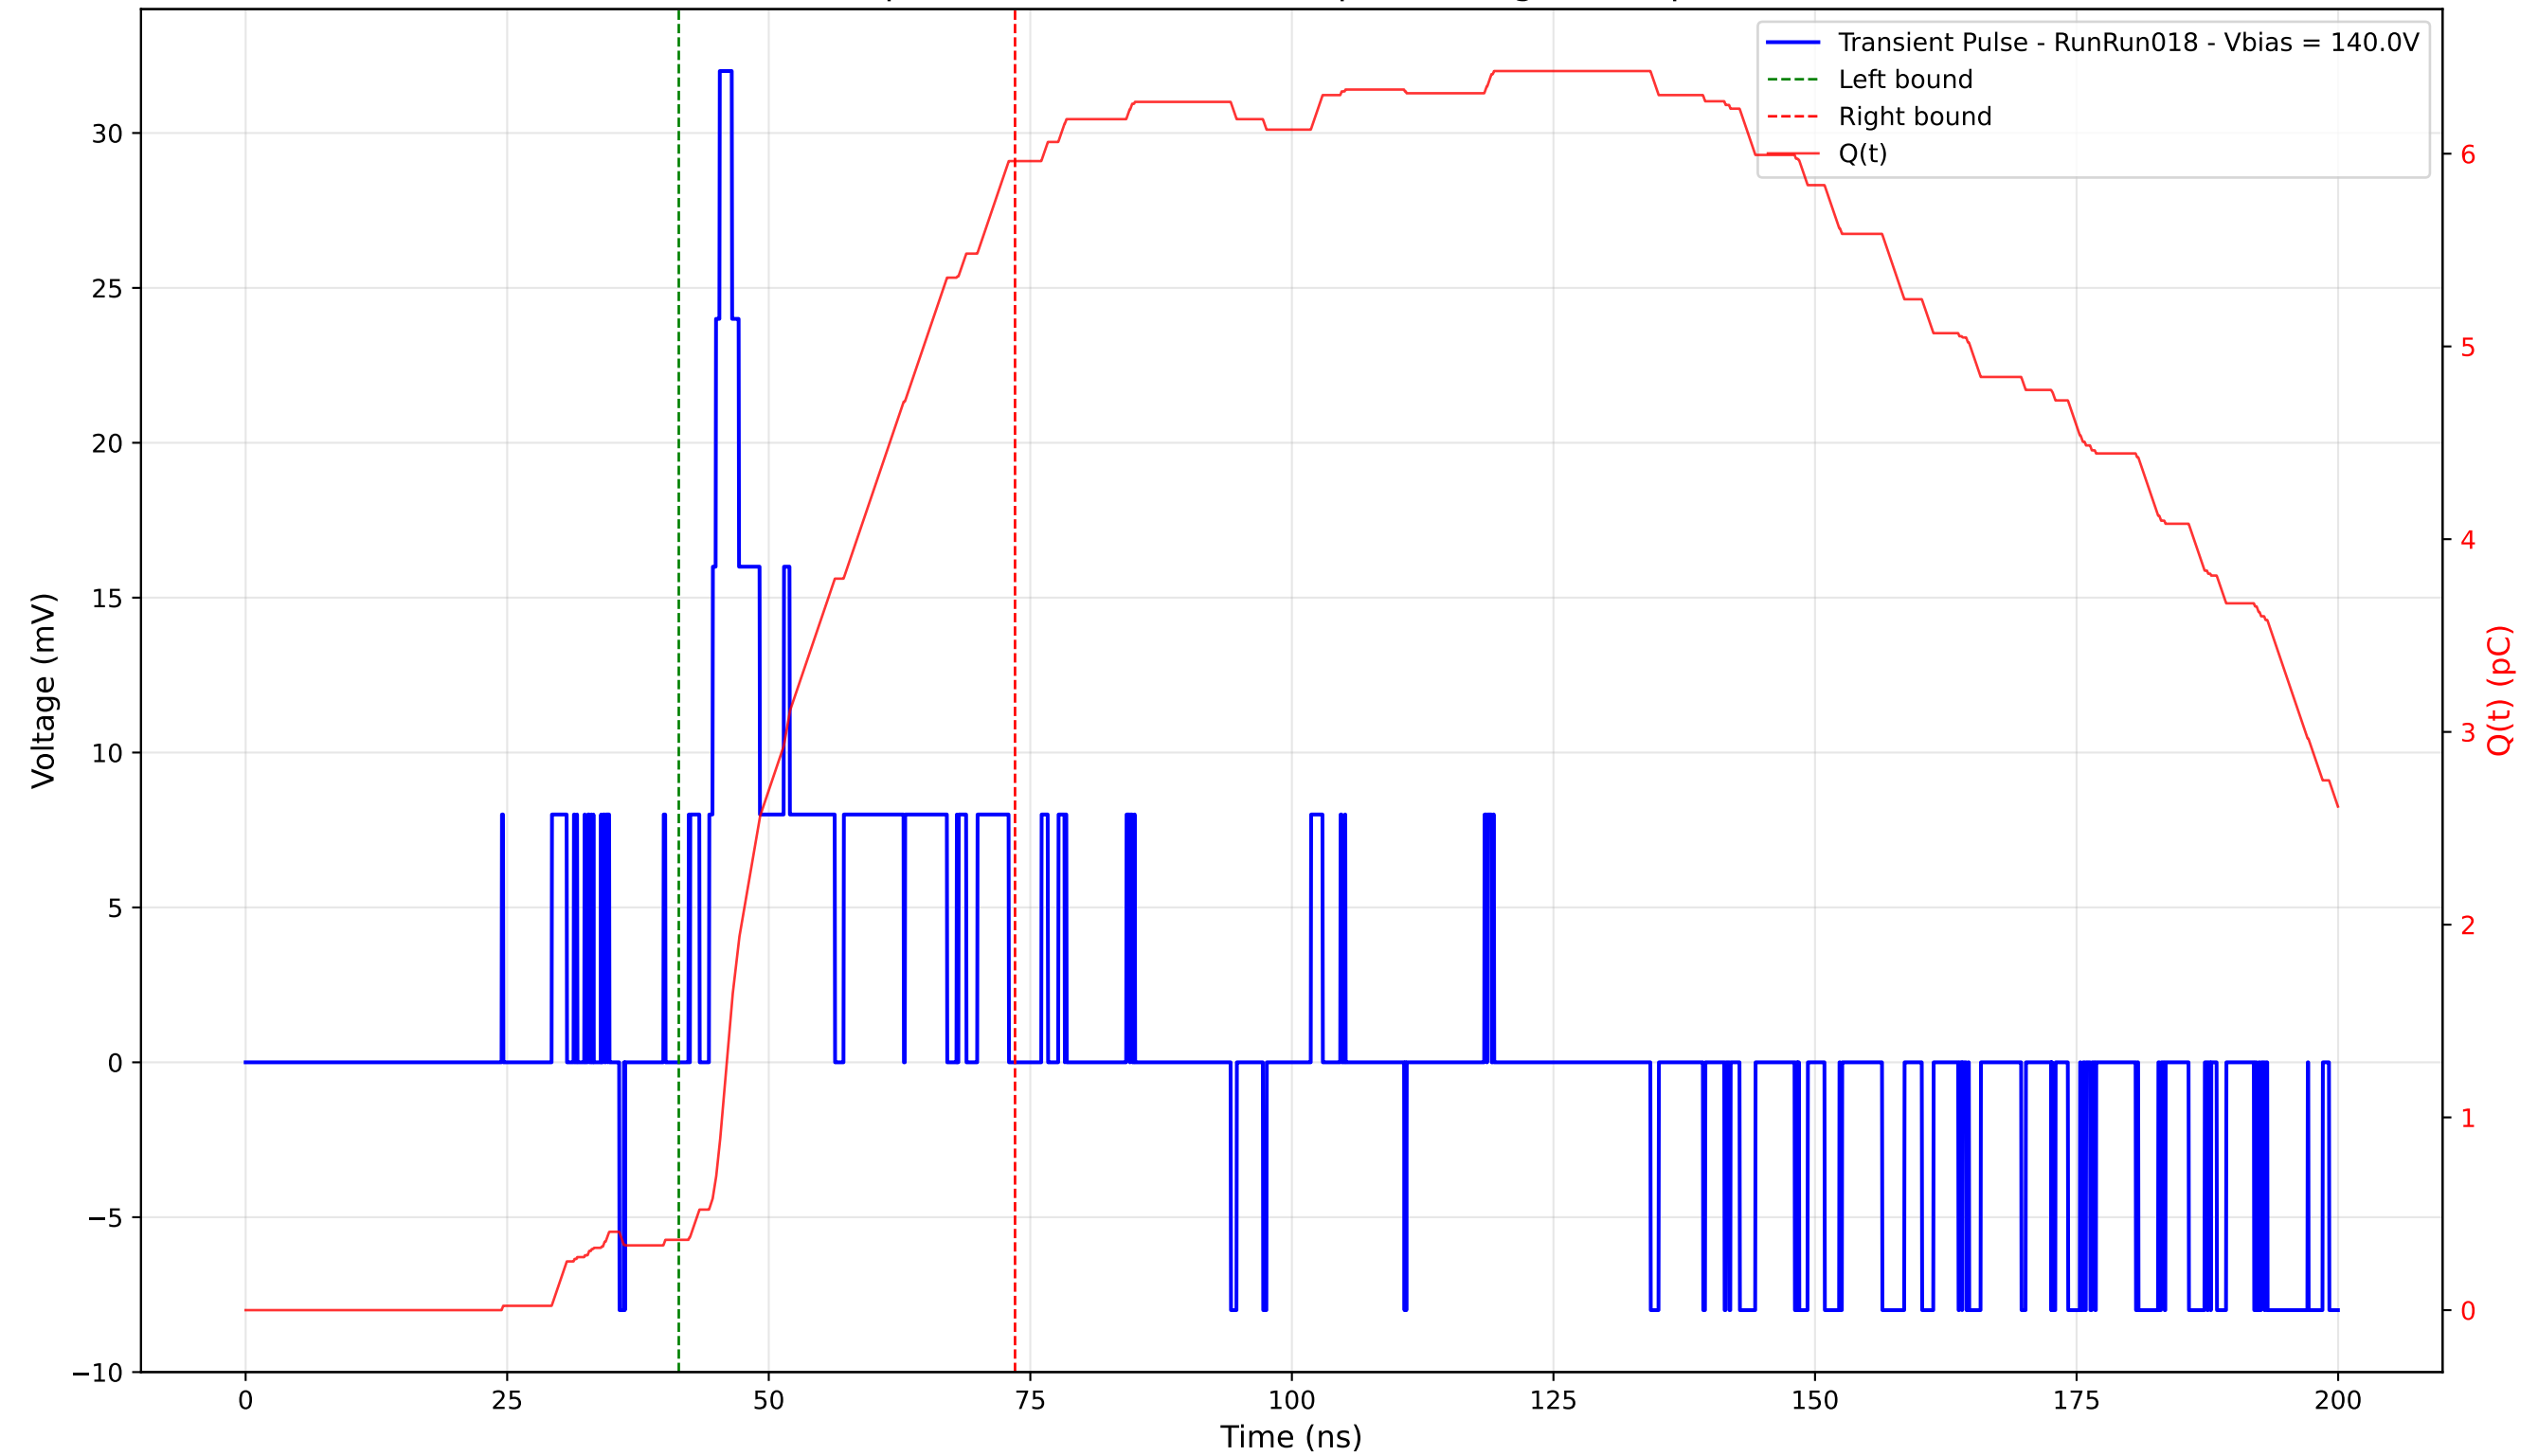


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 3.74 pC - Rise Time: 3.85 ns

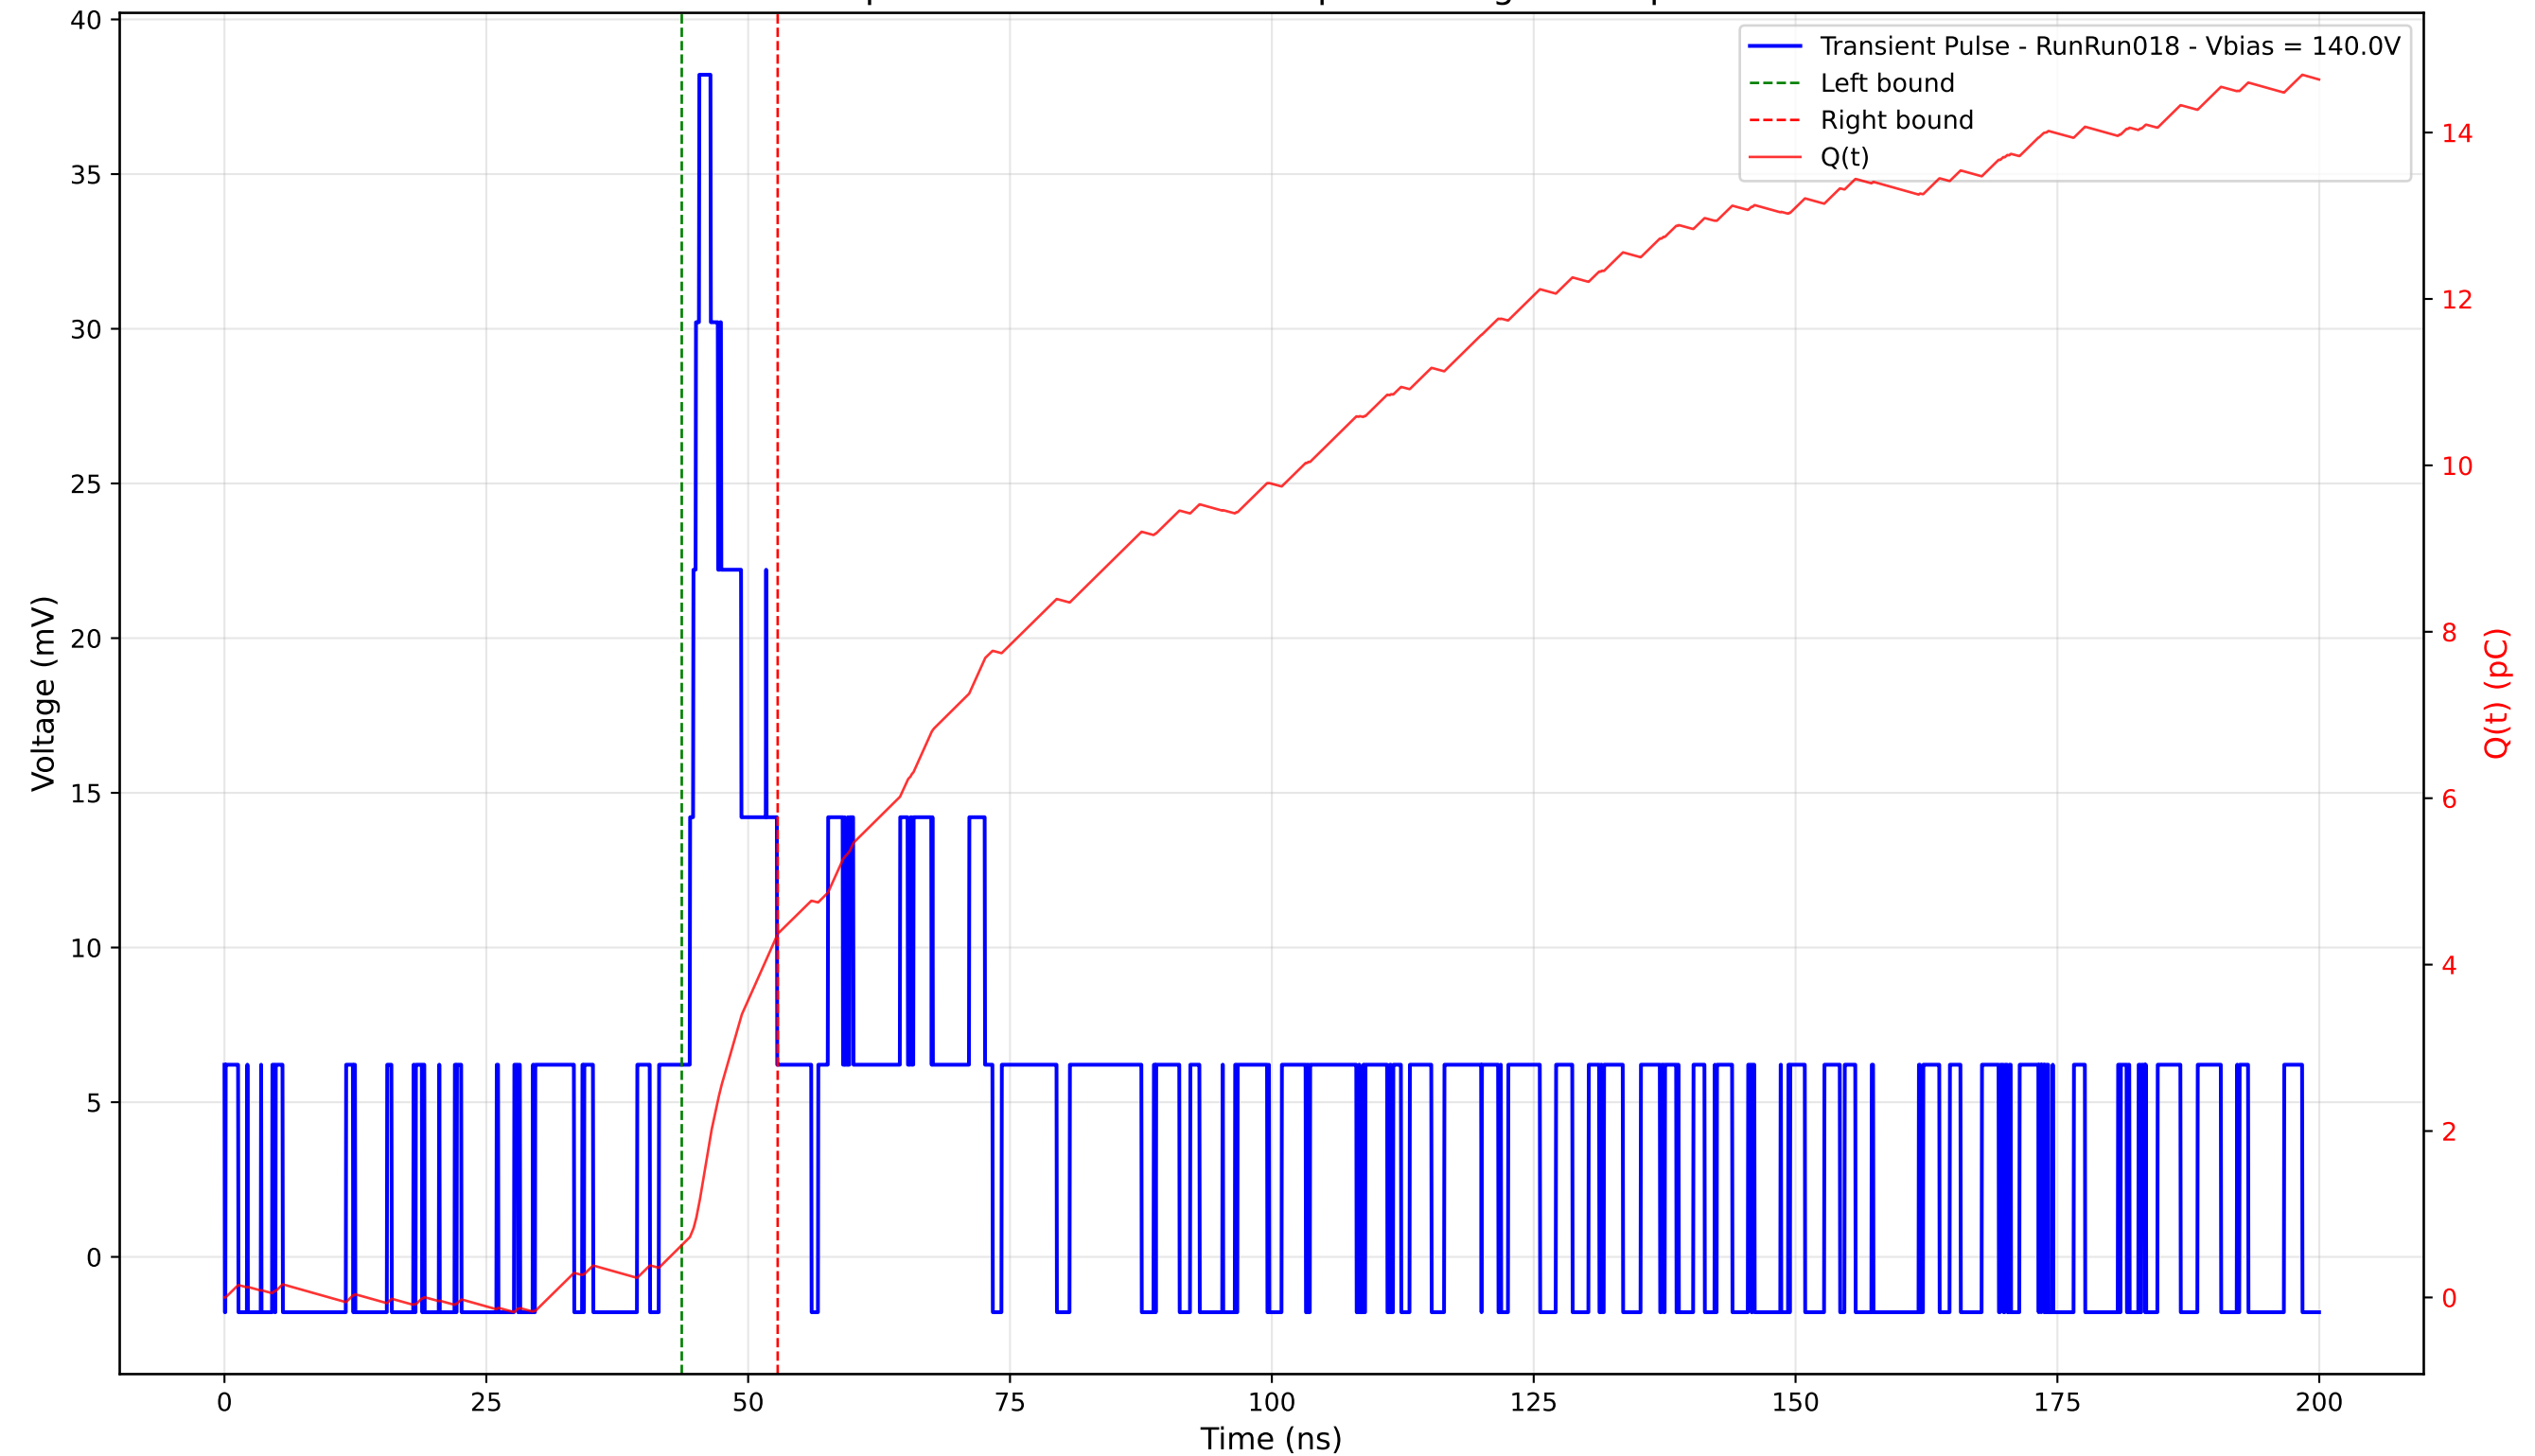


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 4.20 pC - Rise Time: 1.15 ns

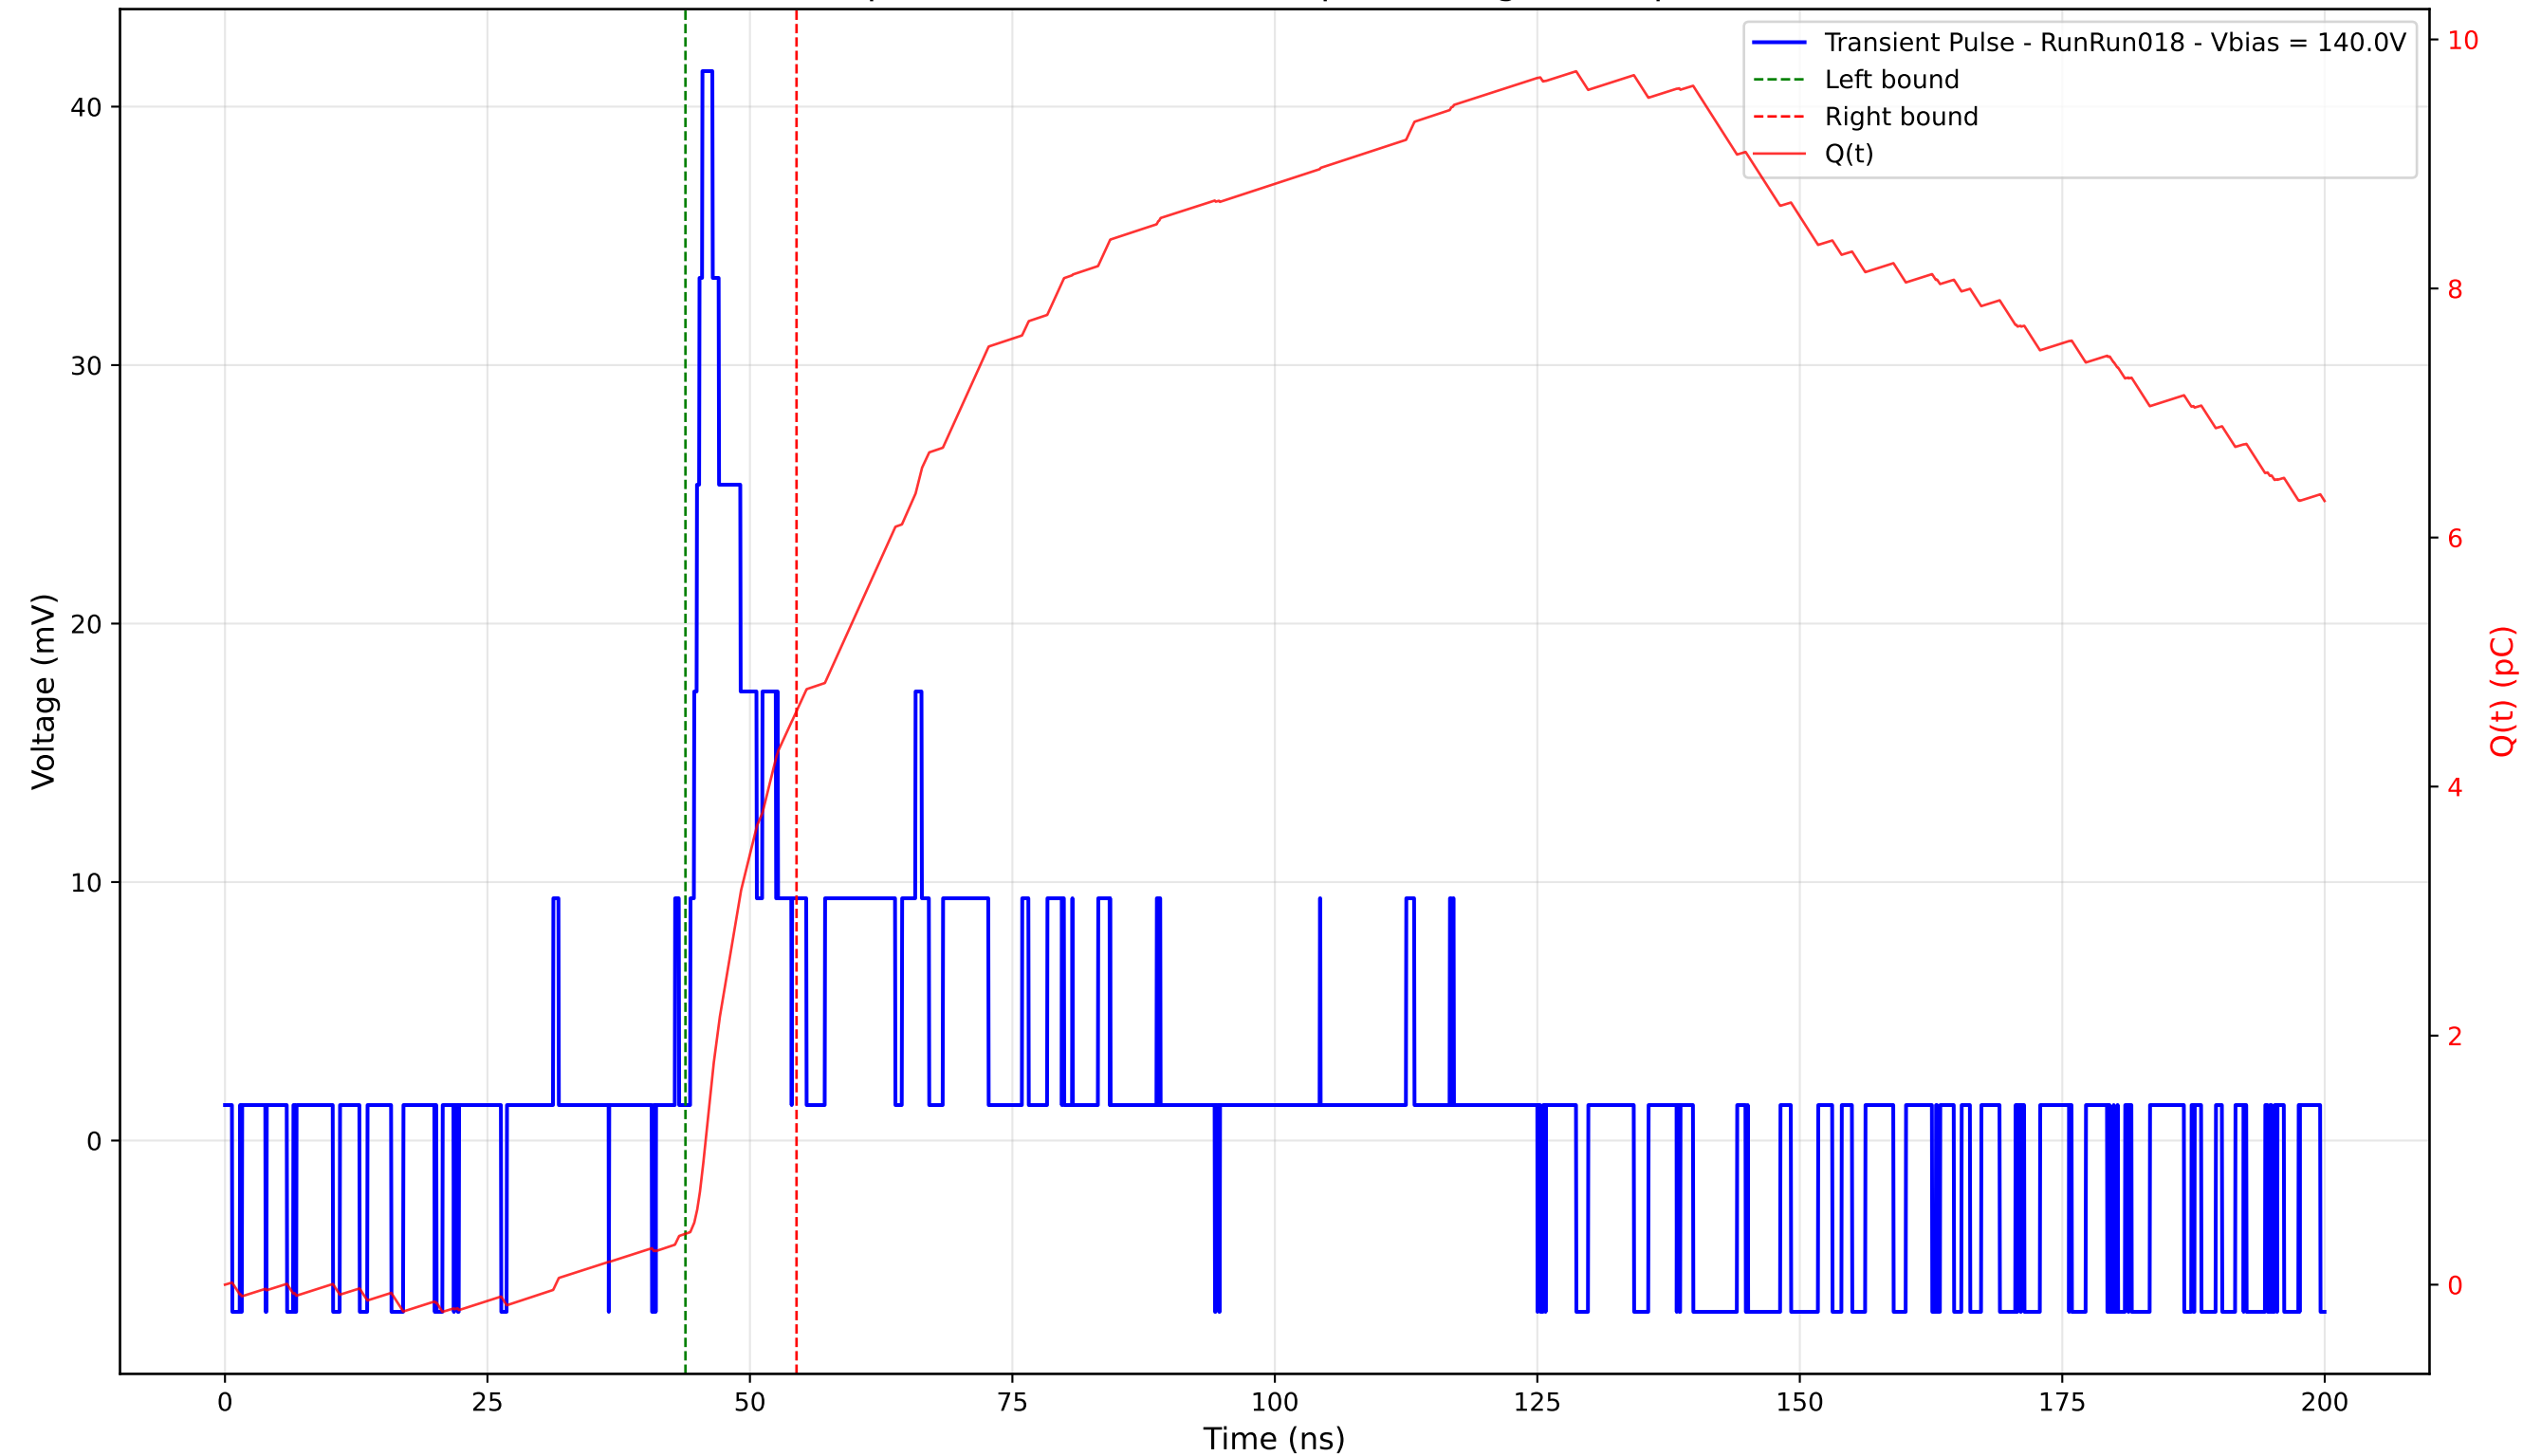

Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 3.75 pC - Rise Time: 3.03 ns

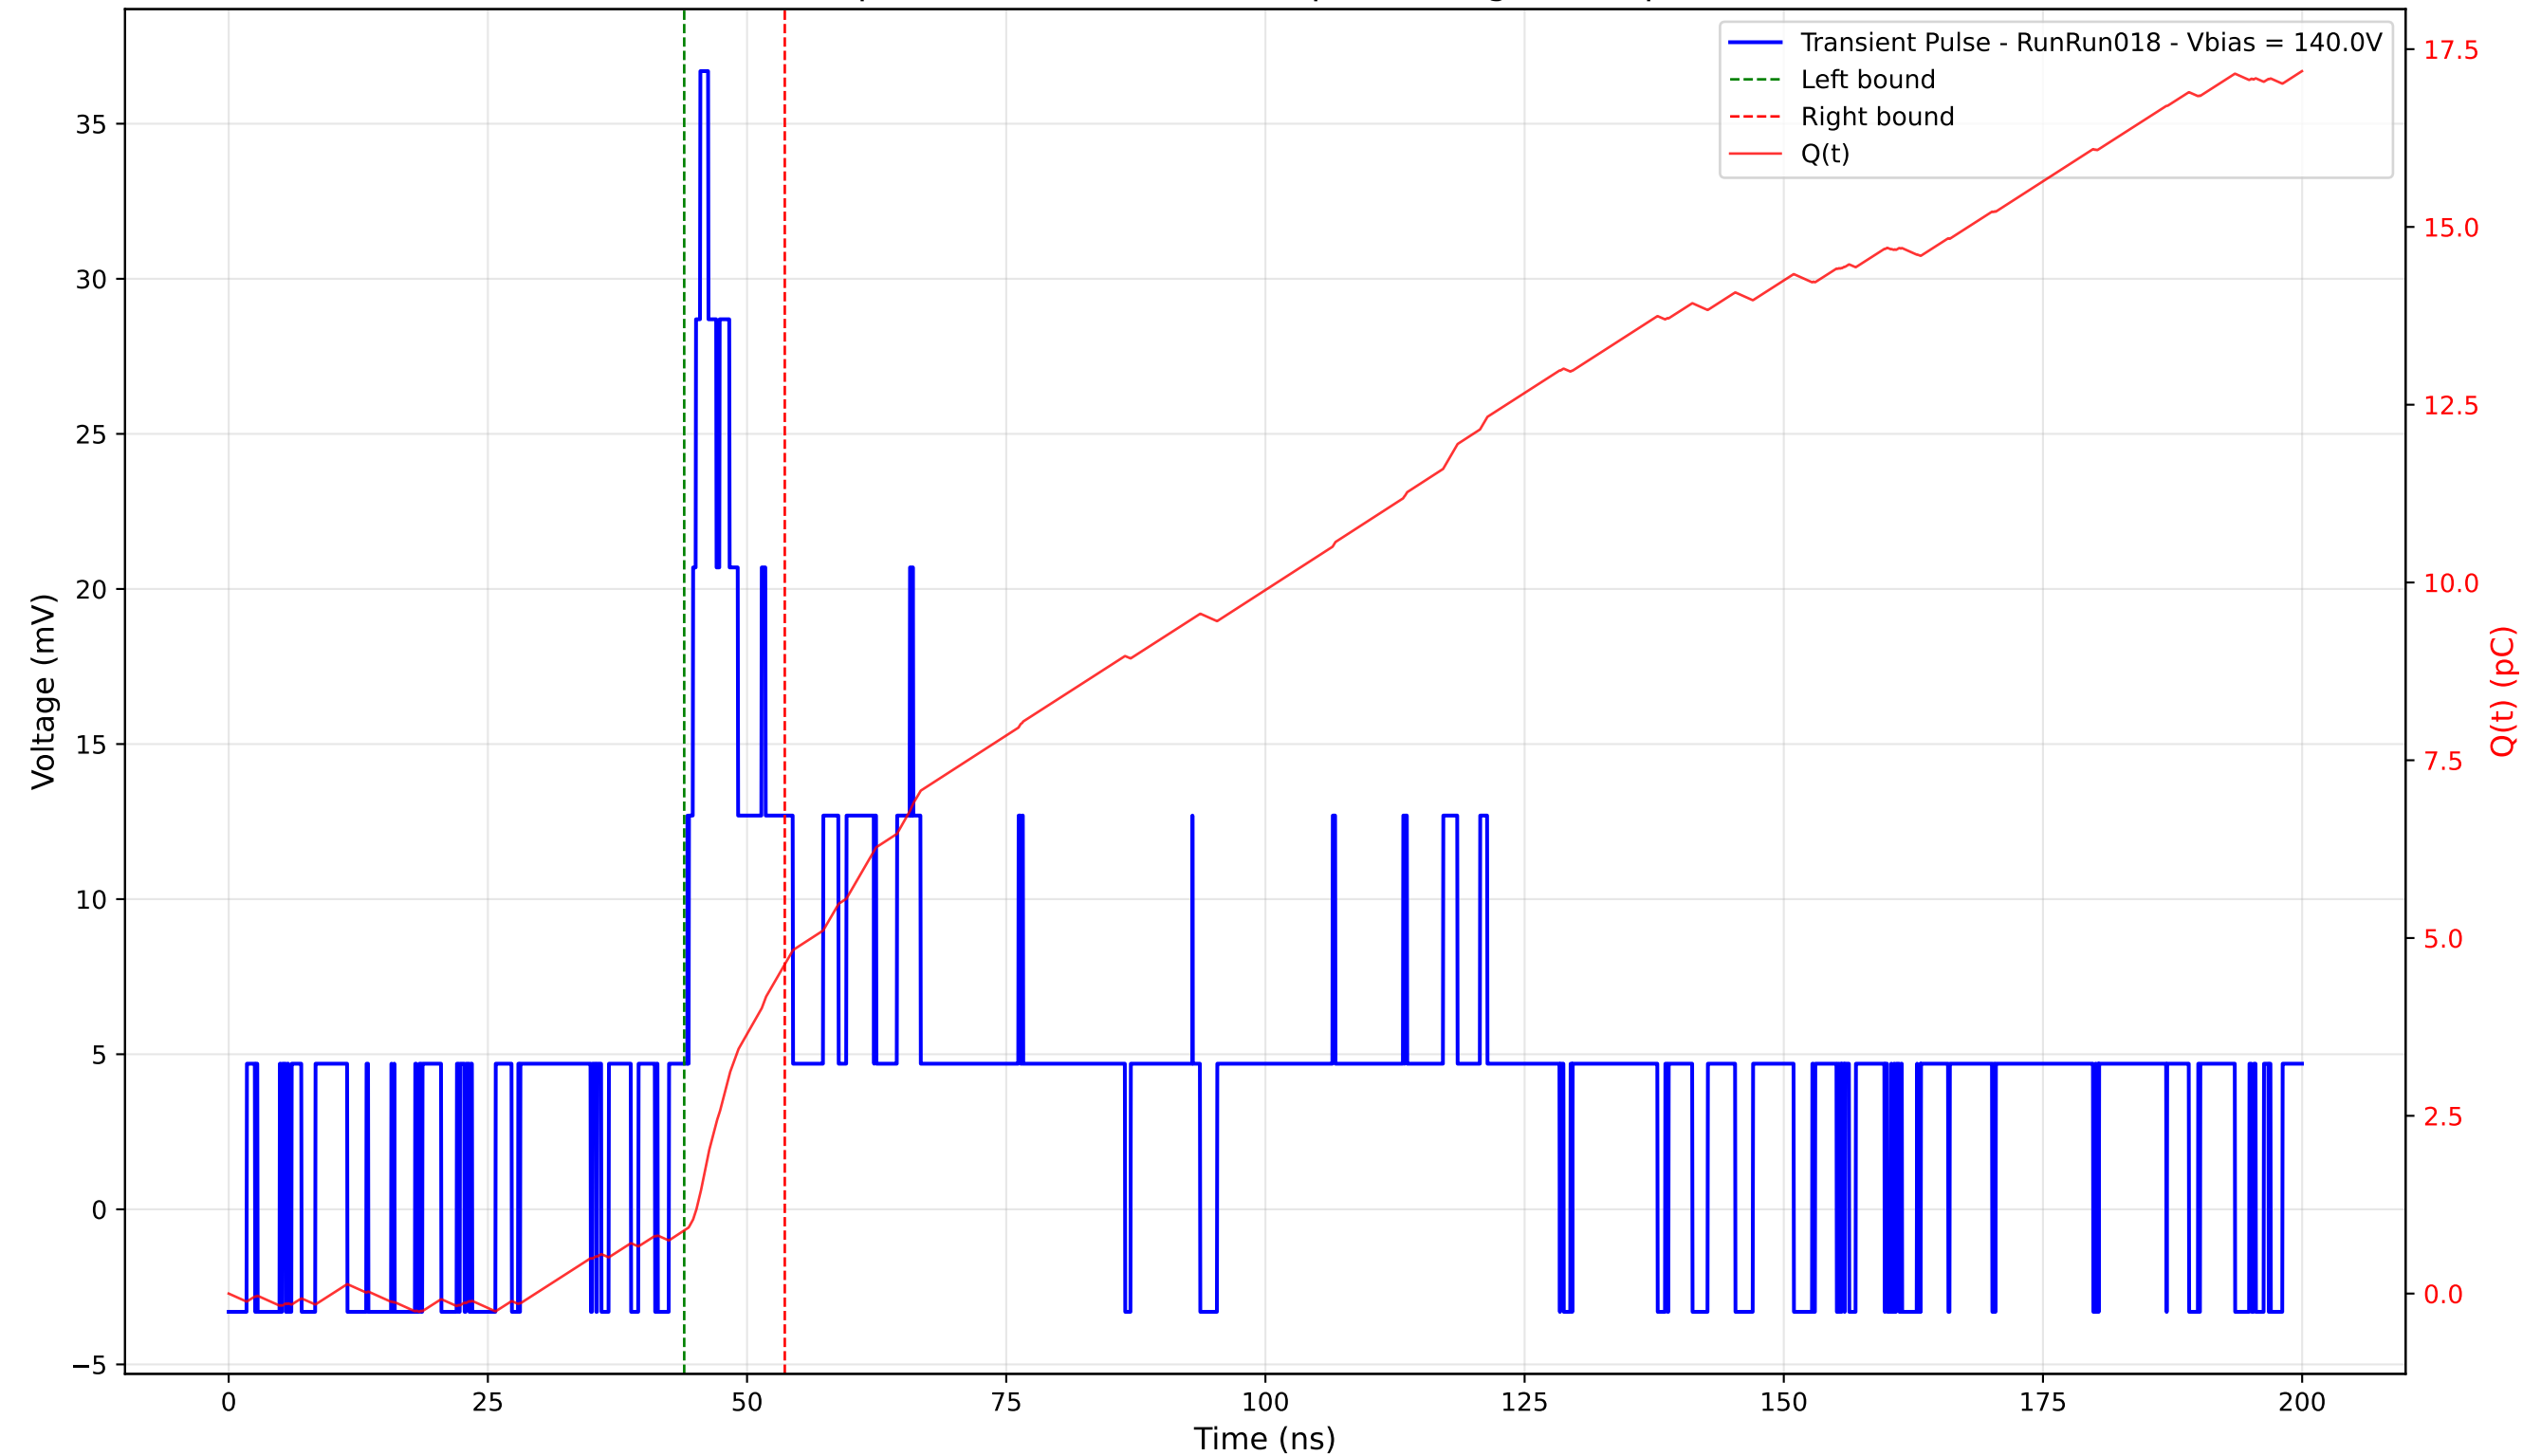


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 1.84 pC - Rise Time: 0.94 ns

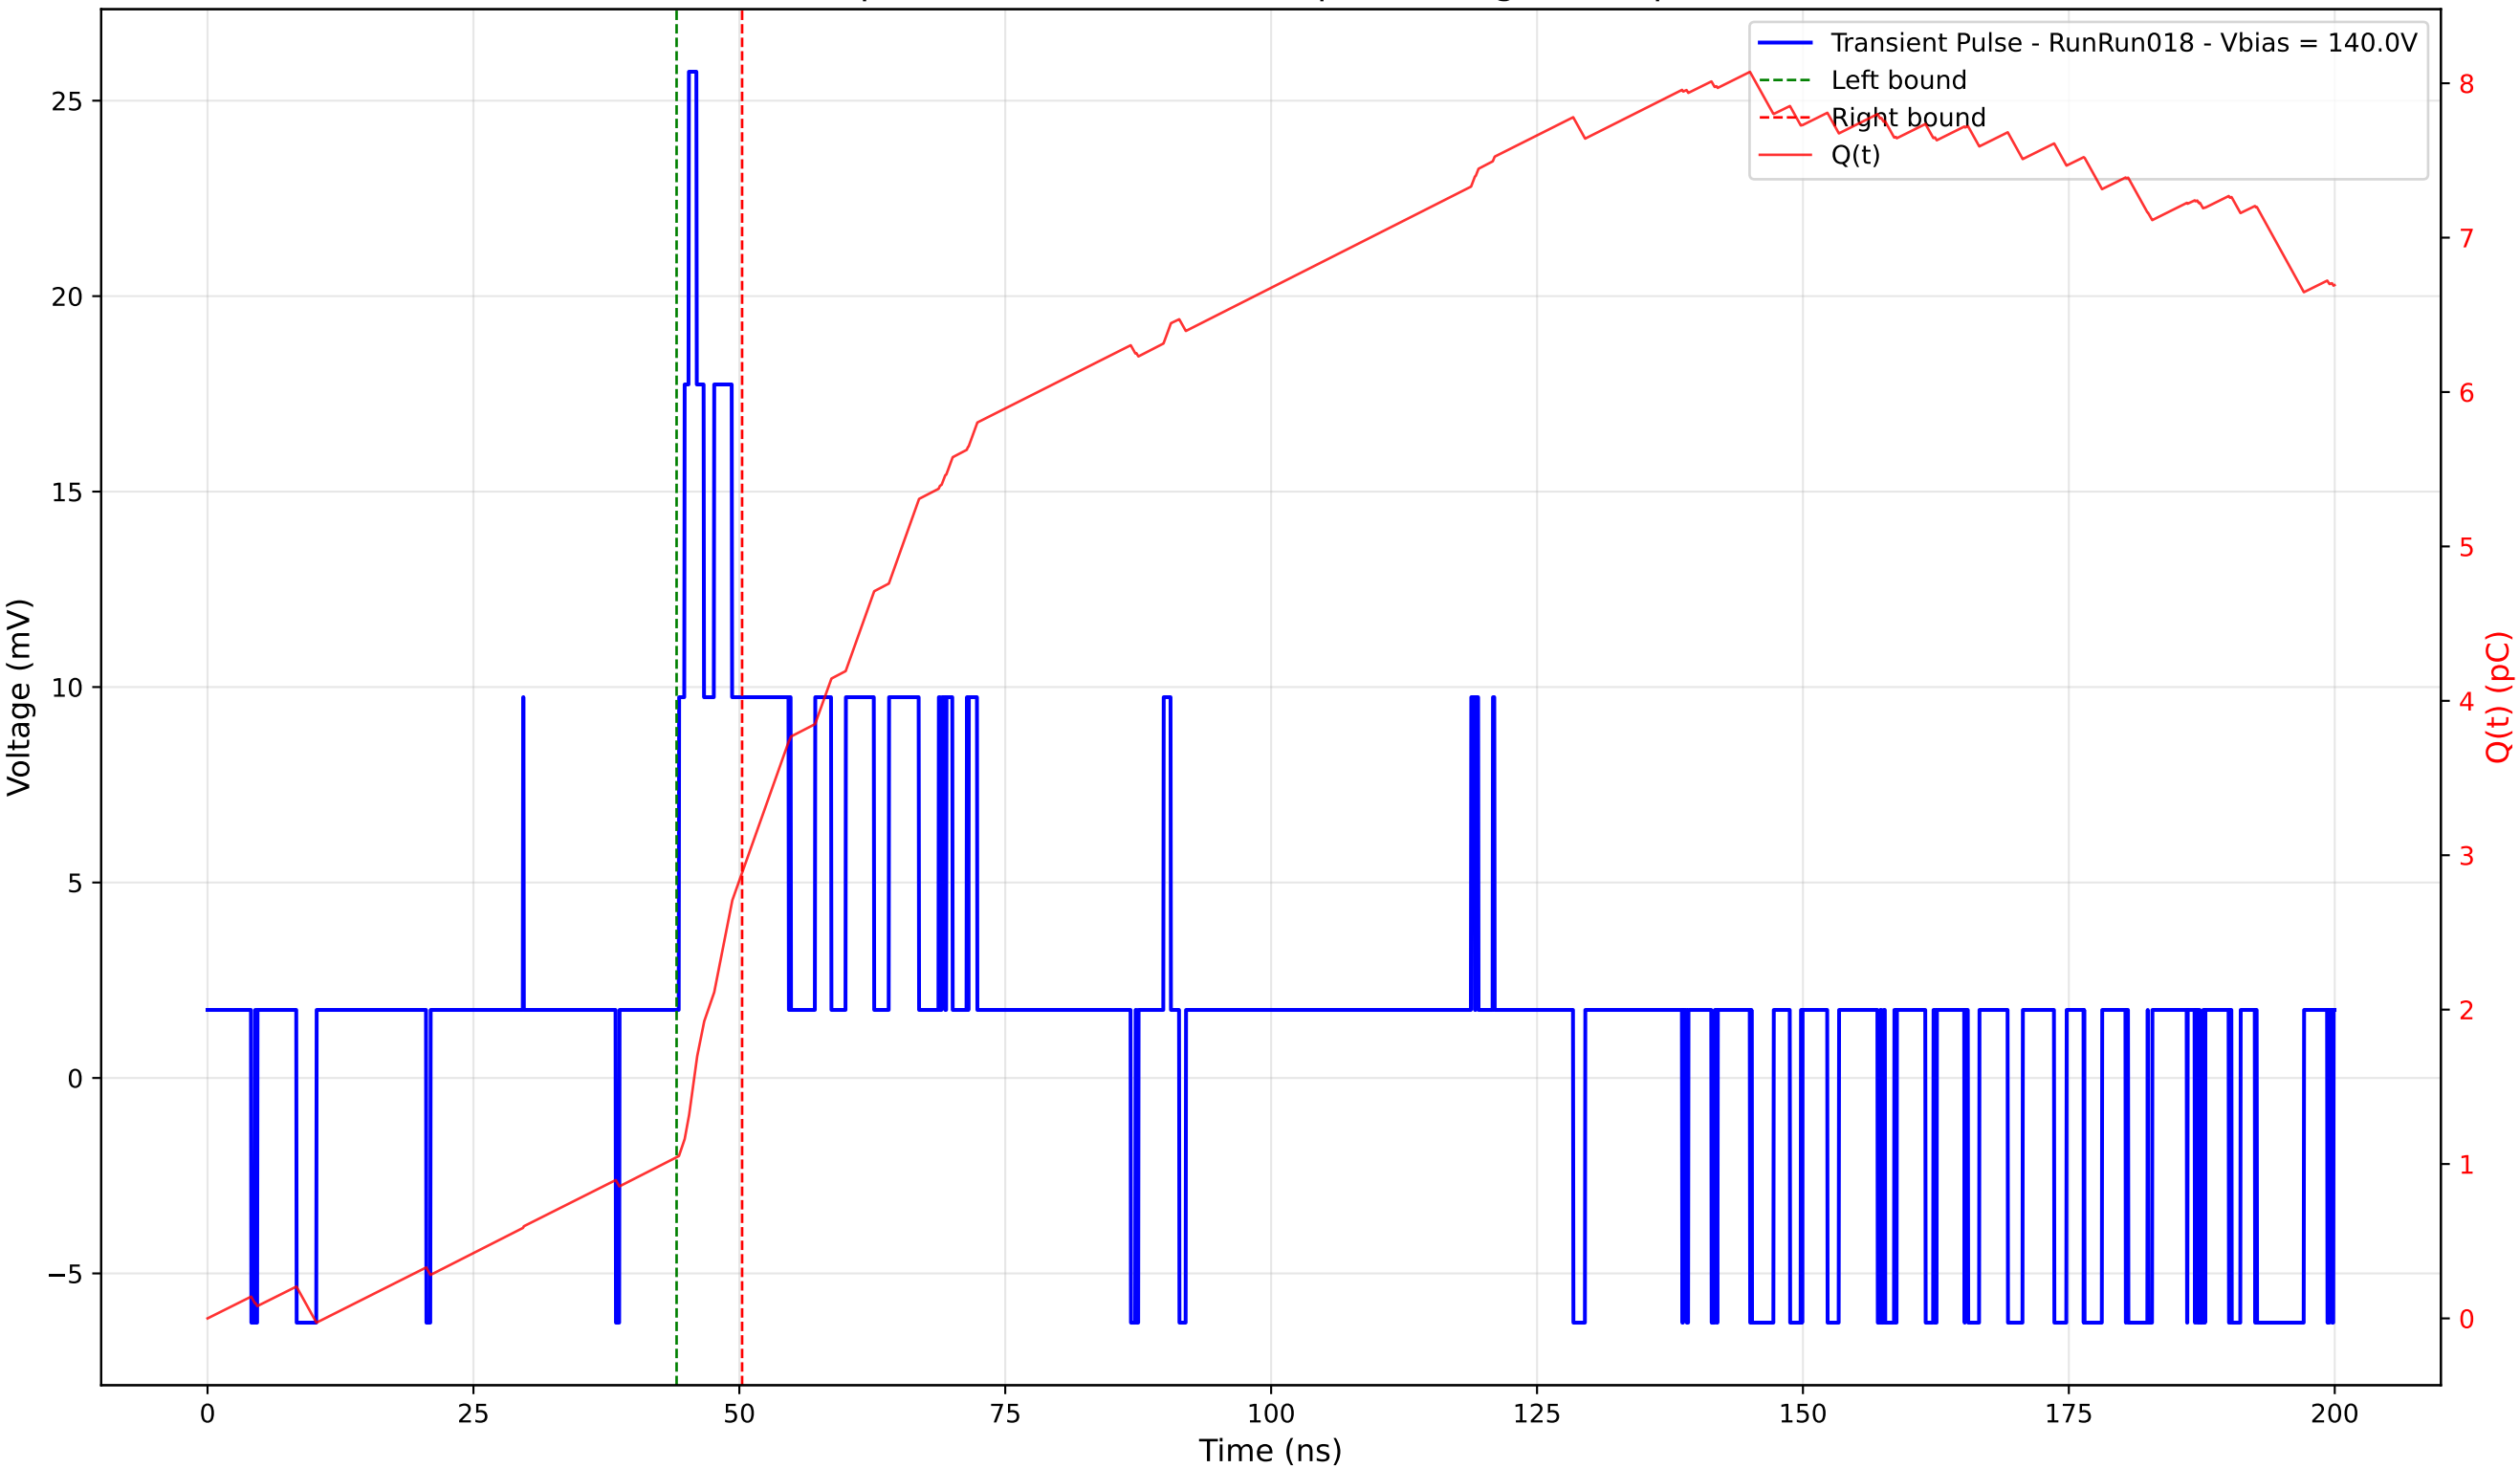


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 2.51 pC - Rise Time: 0.00 ns (N/A)




Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 3.88 pC - Rise Time: 0.00 ns (N/A)

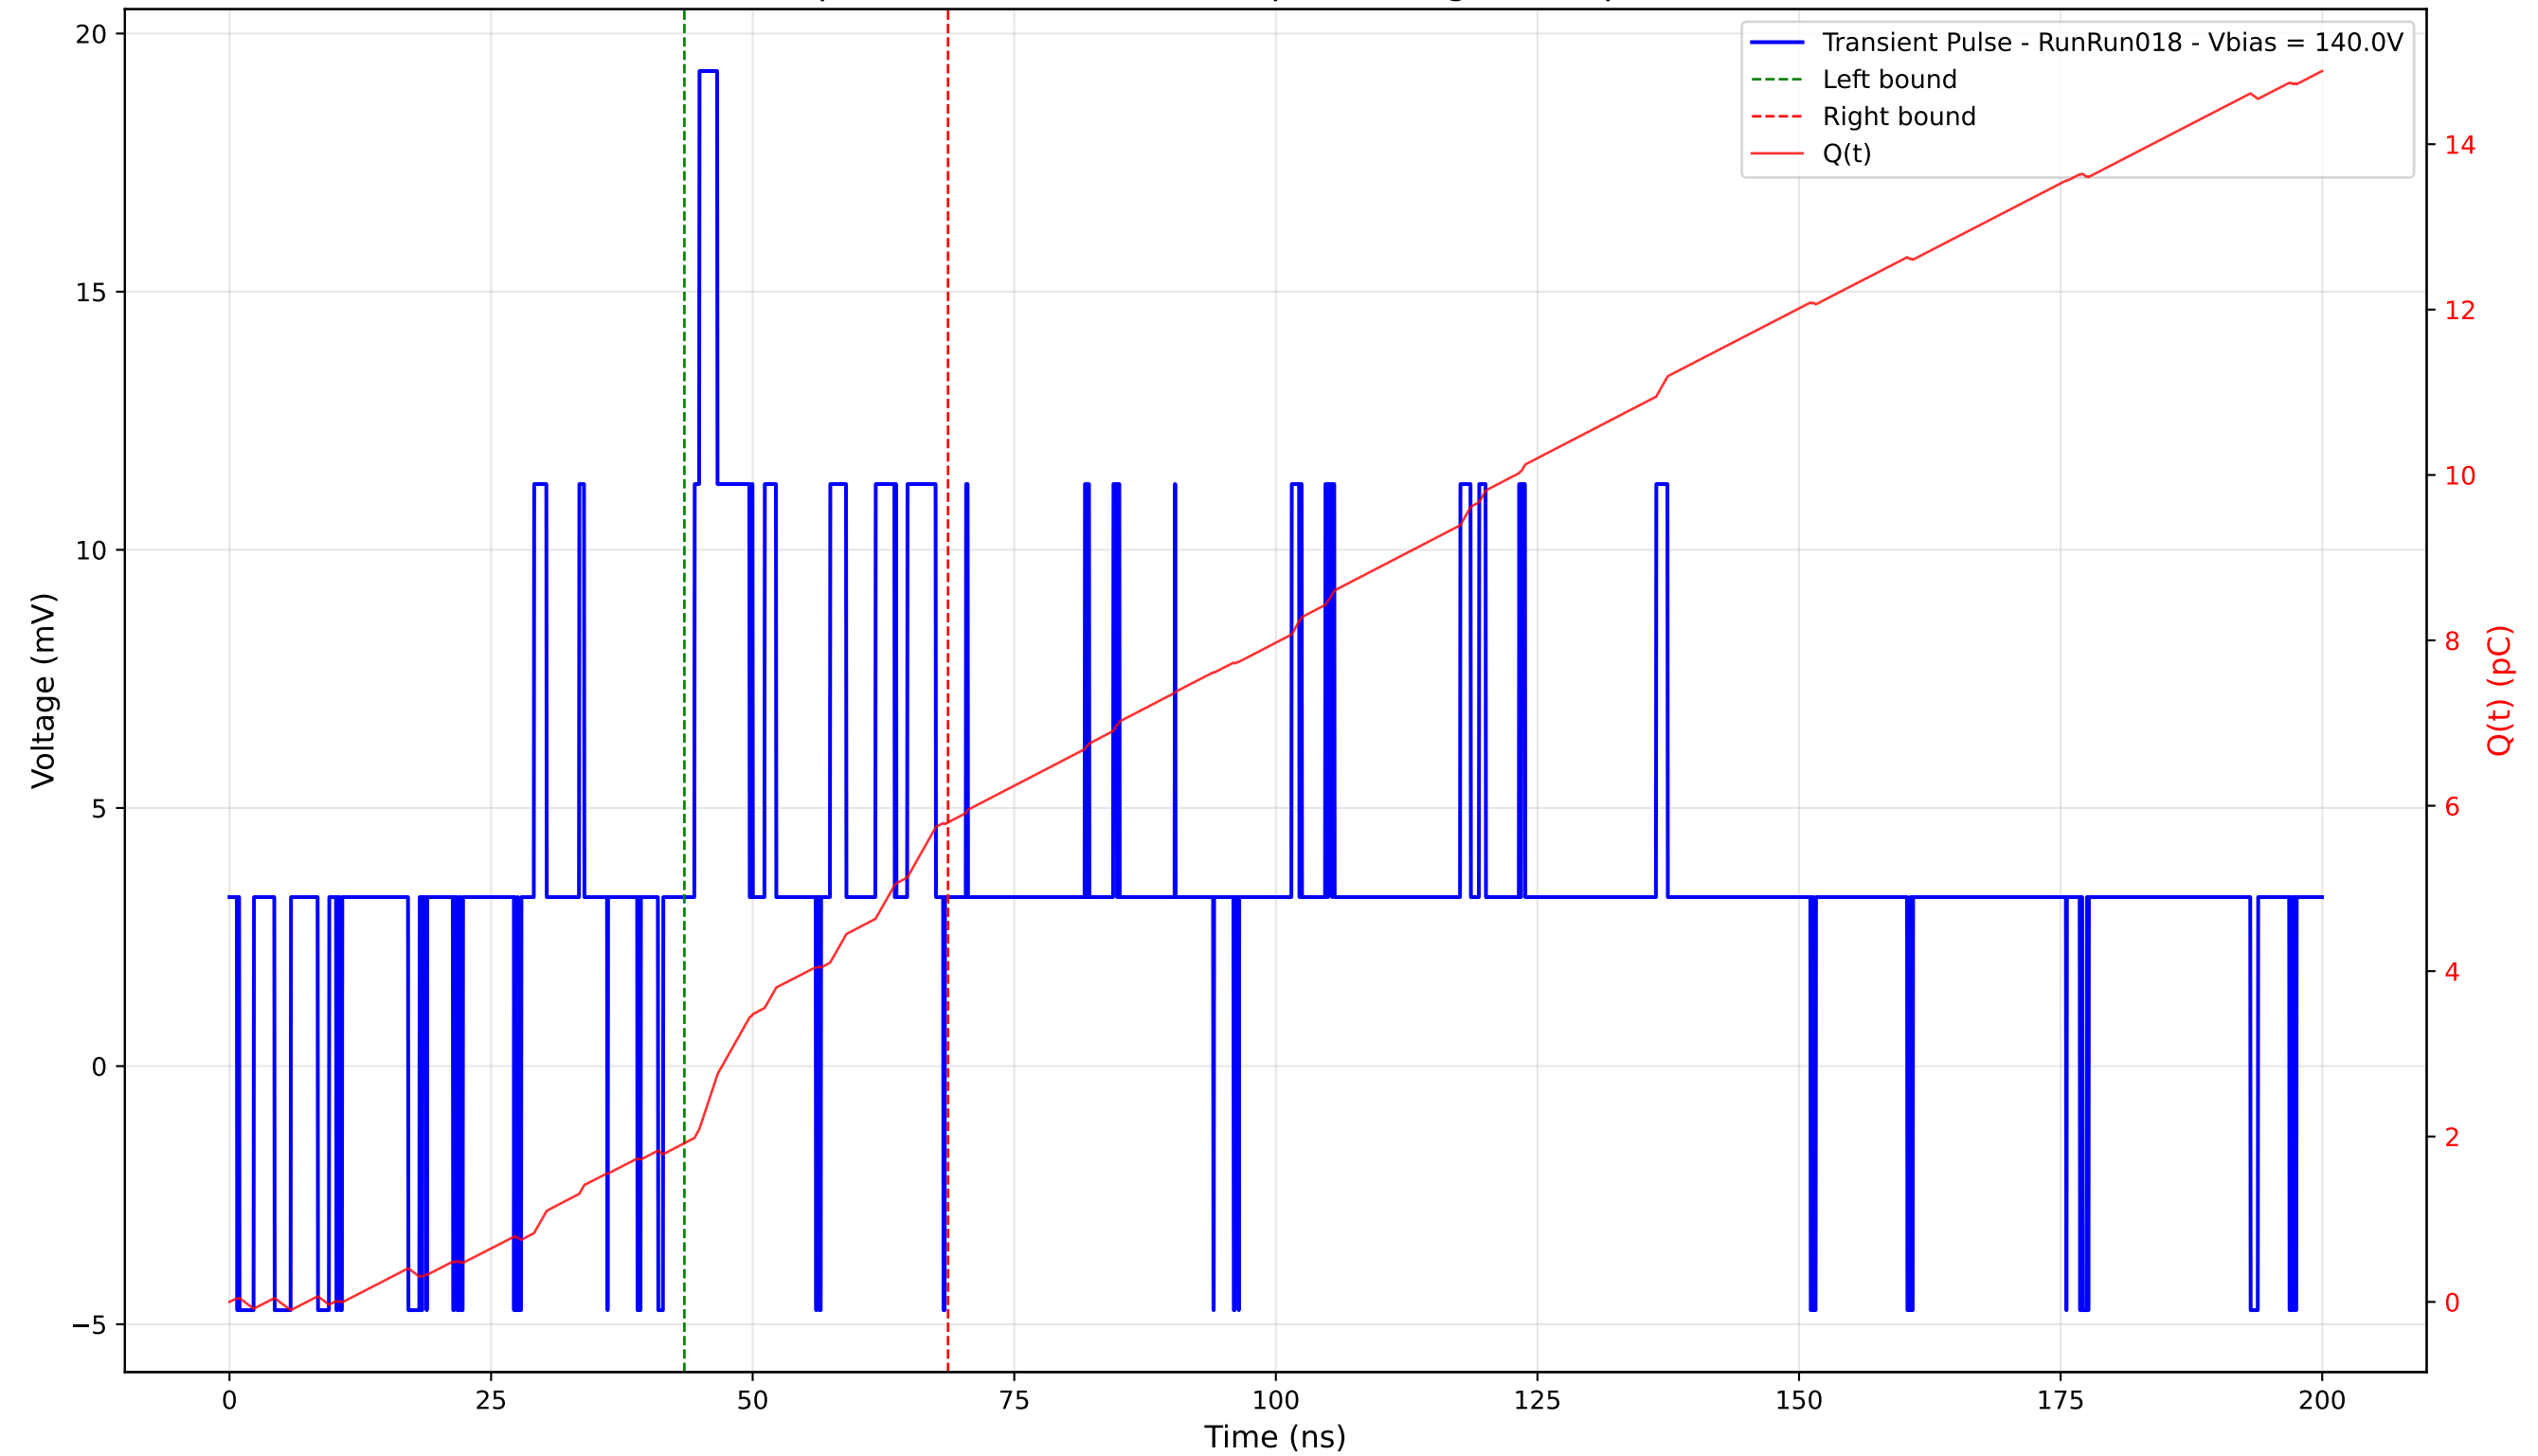


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 1.70 pC - Rise Time: 0.00 ns (N/A)

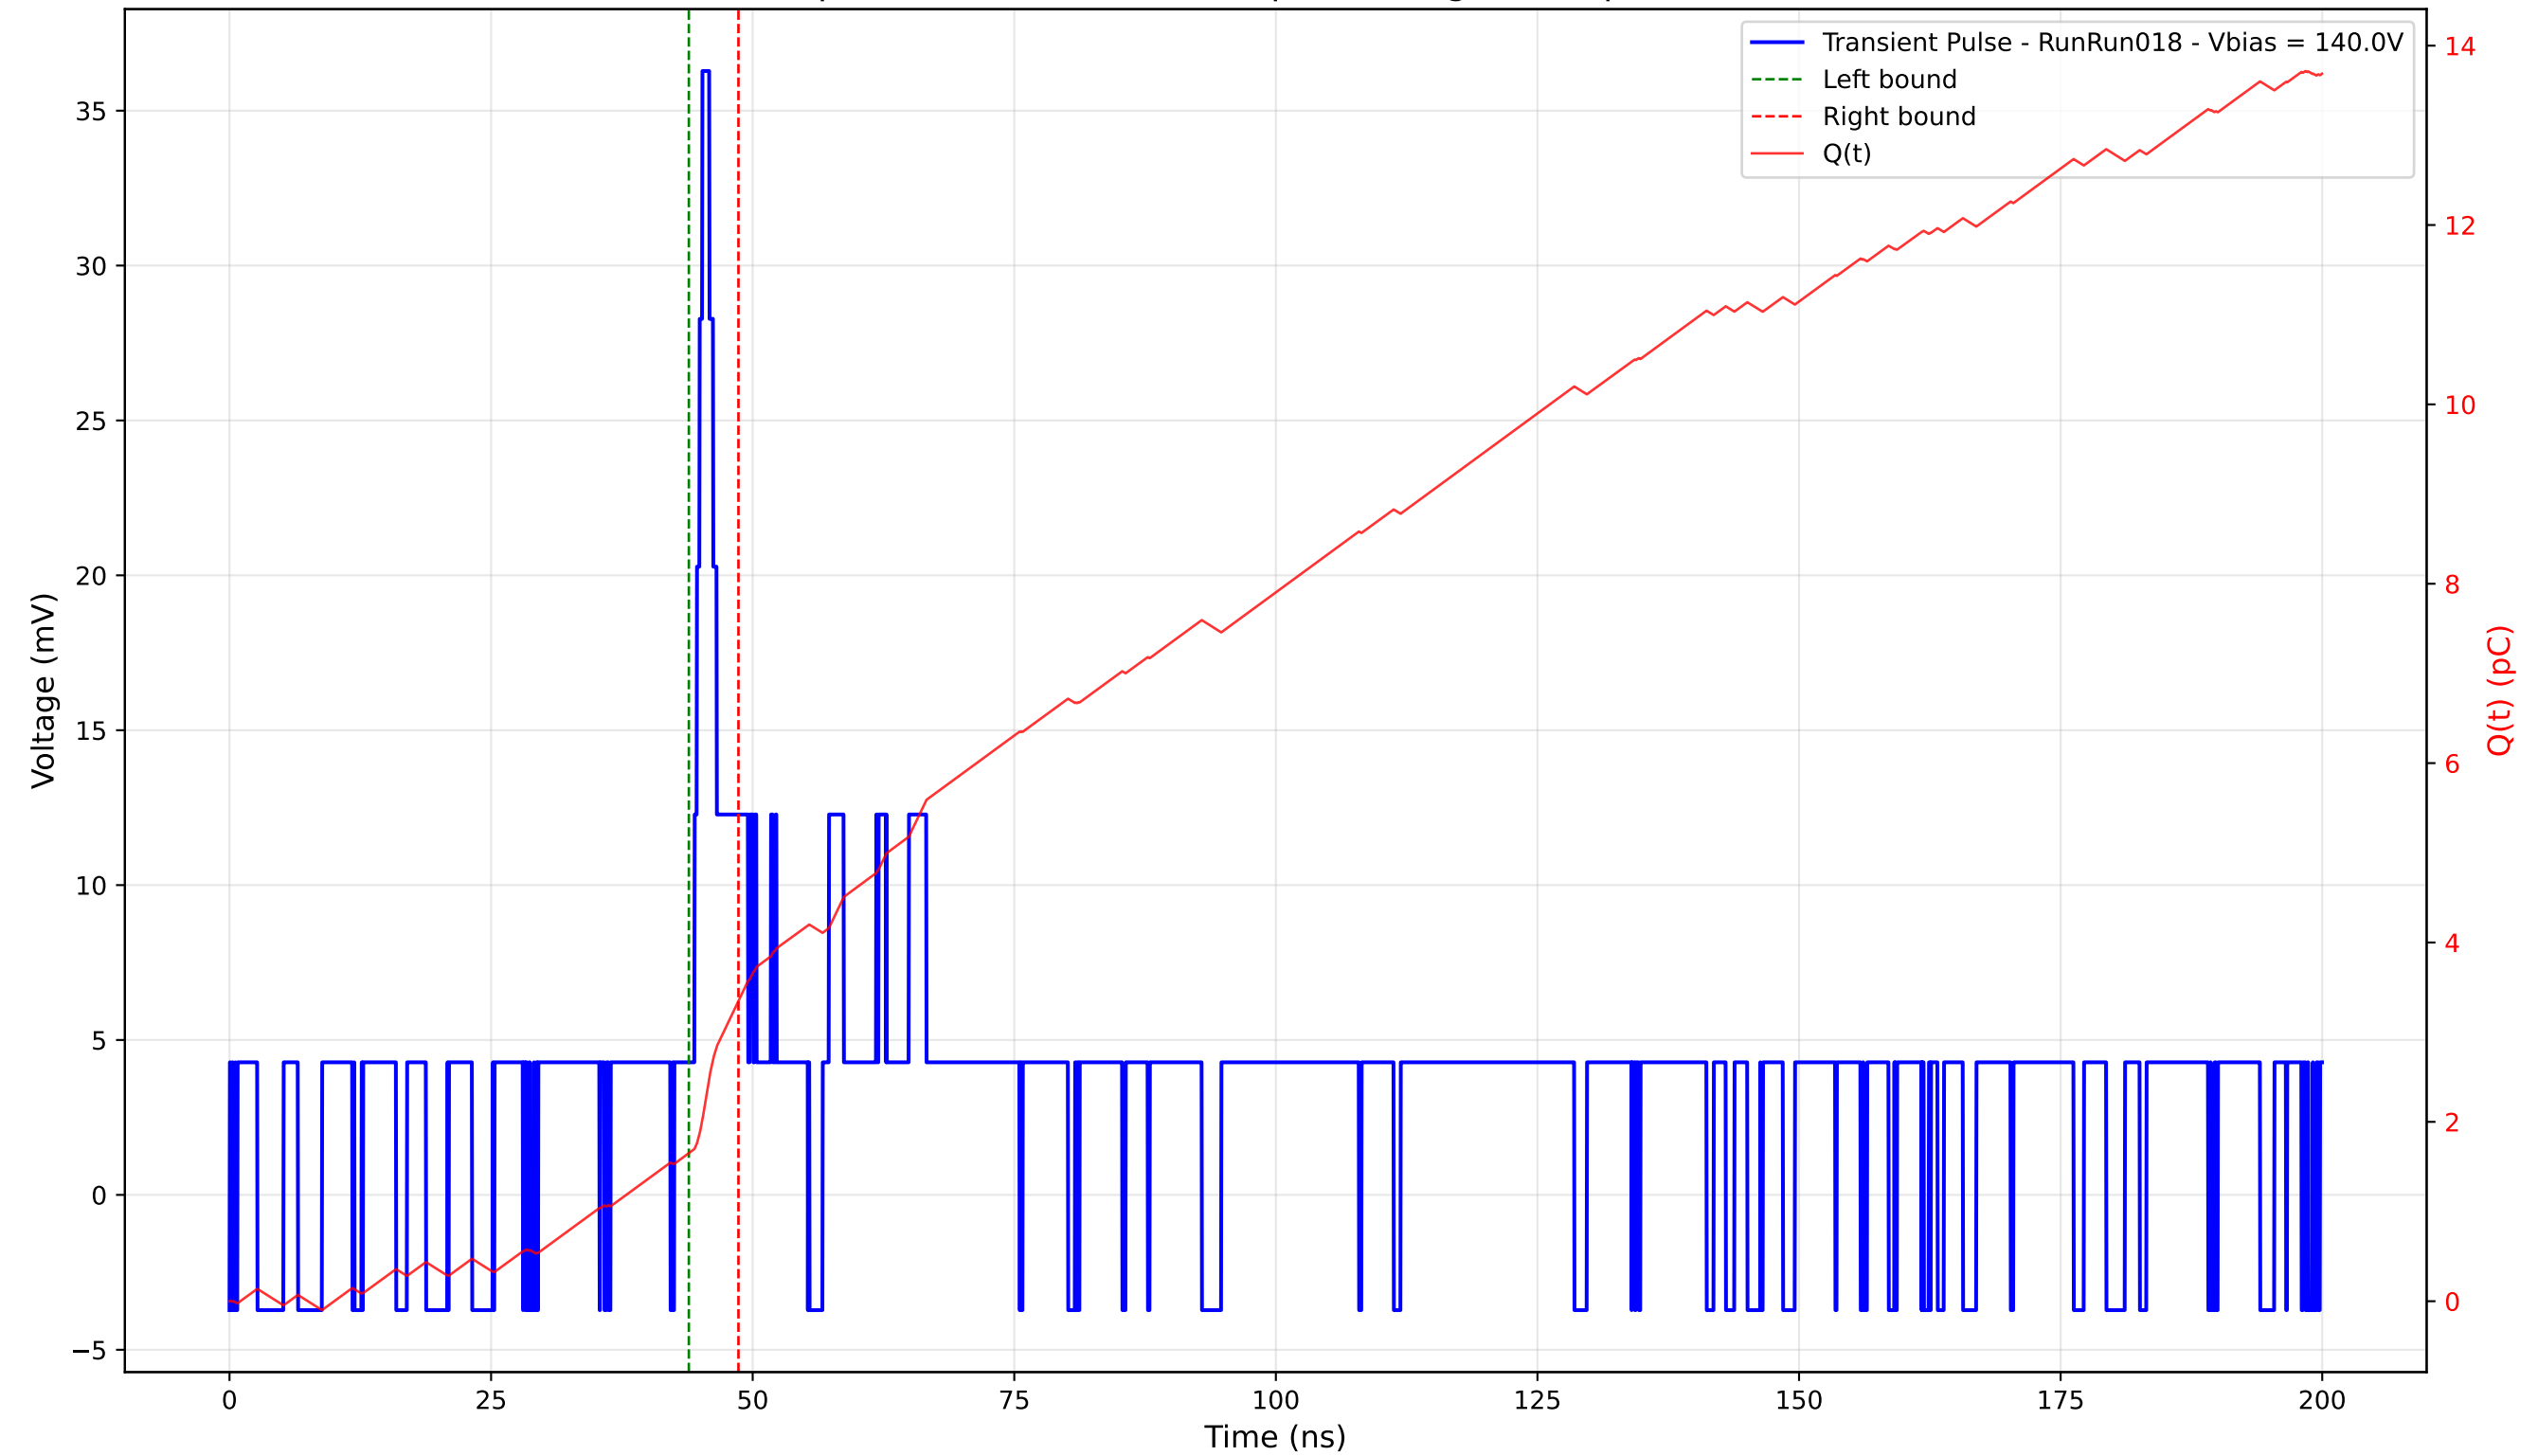


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 2.66 pC - Rise Time: 0.96 ns

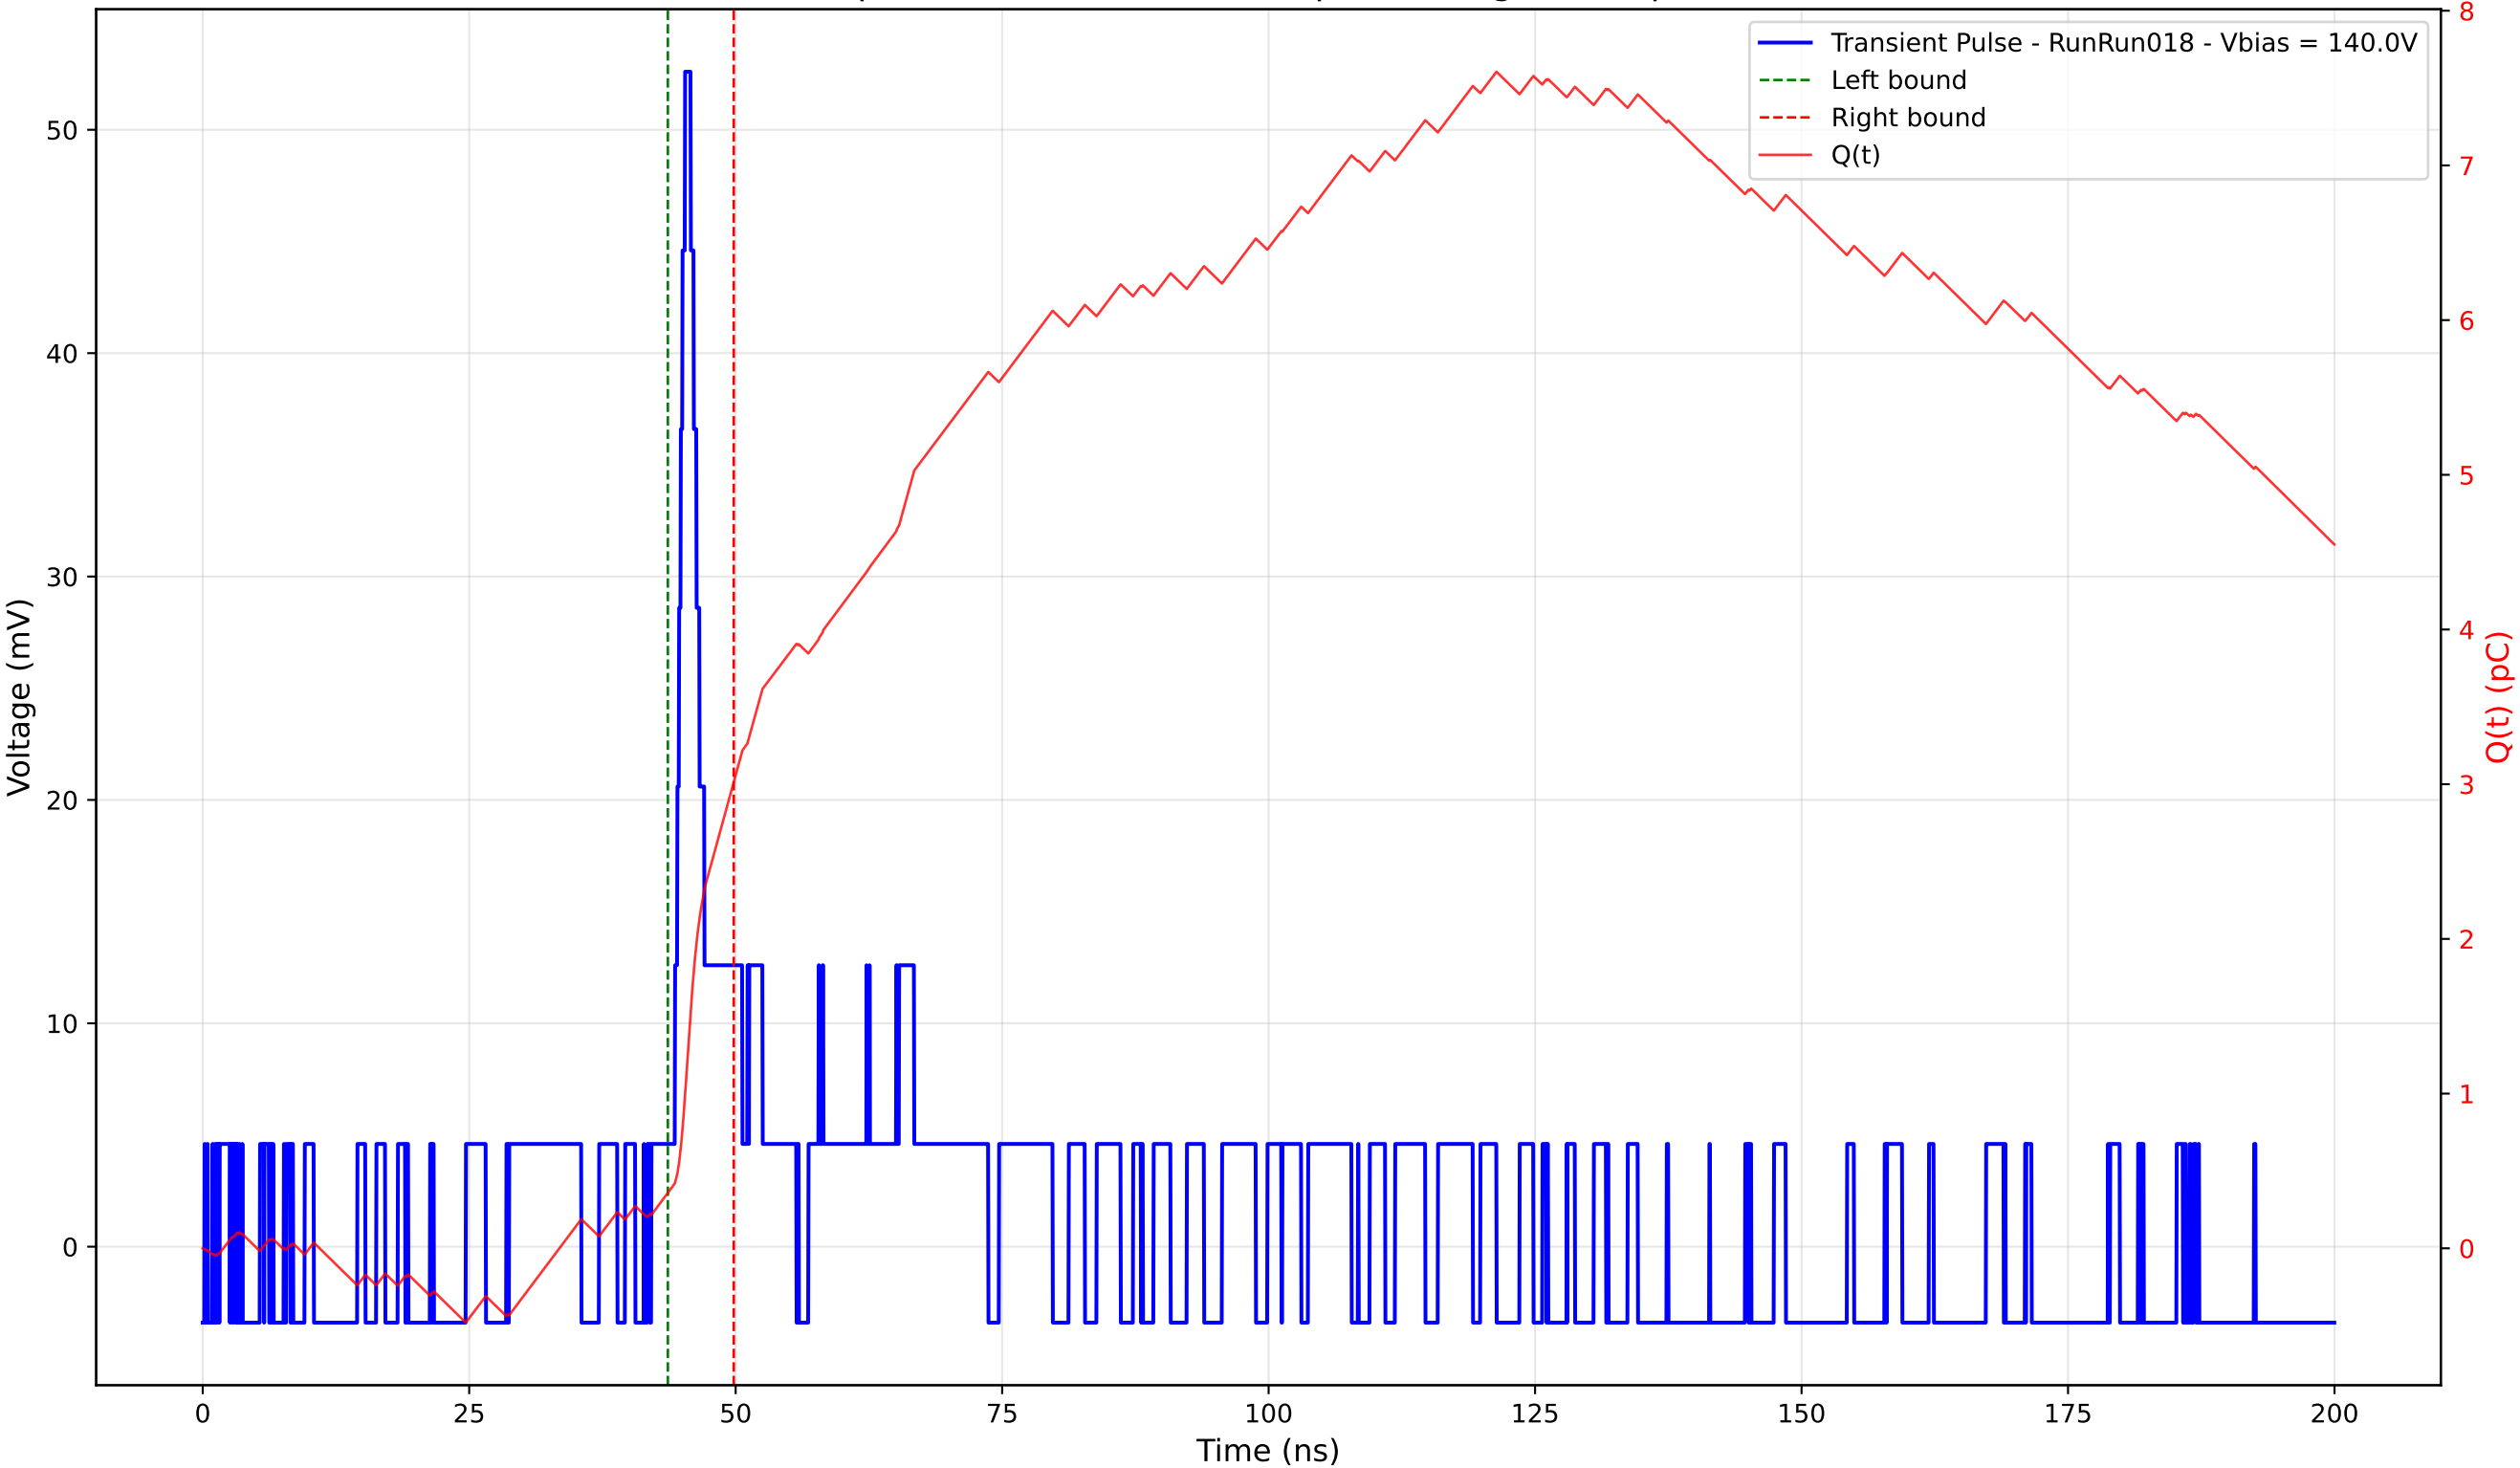


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 4.53 pC - Rise Time: 1.01 ns

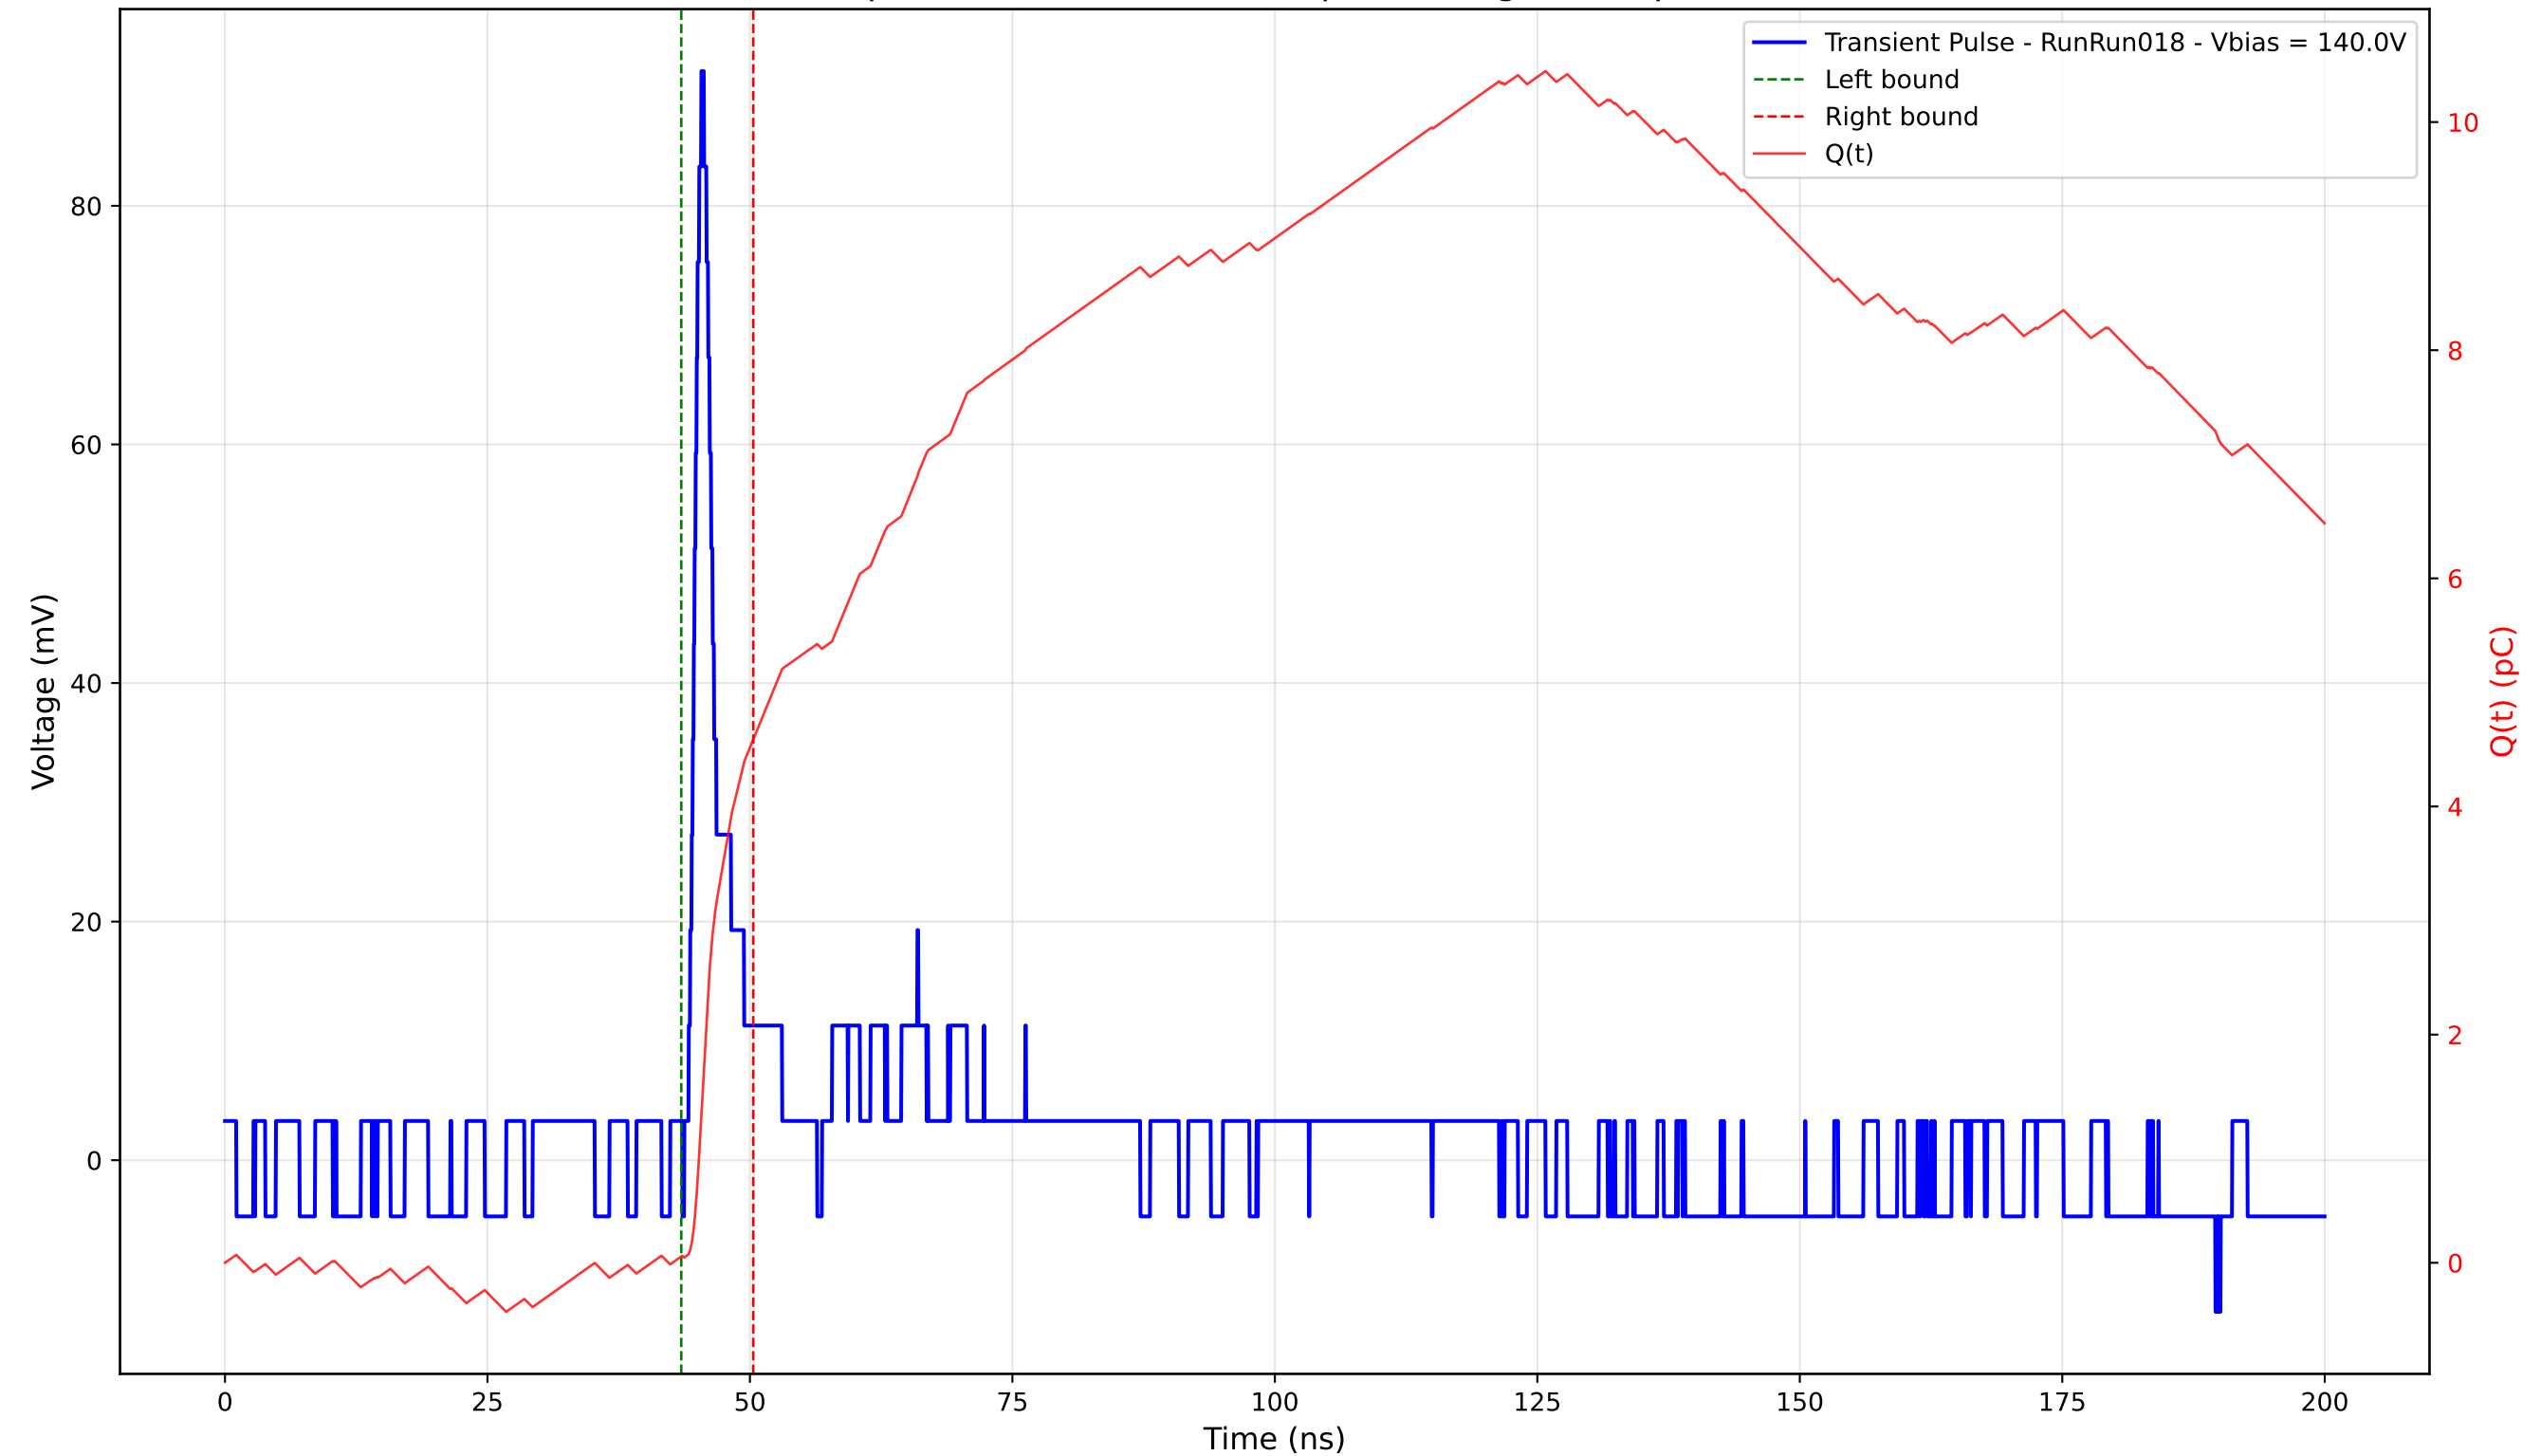


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 7.71 pC - Rise Time: 0.91 ns

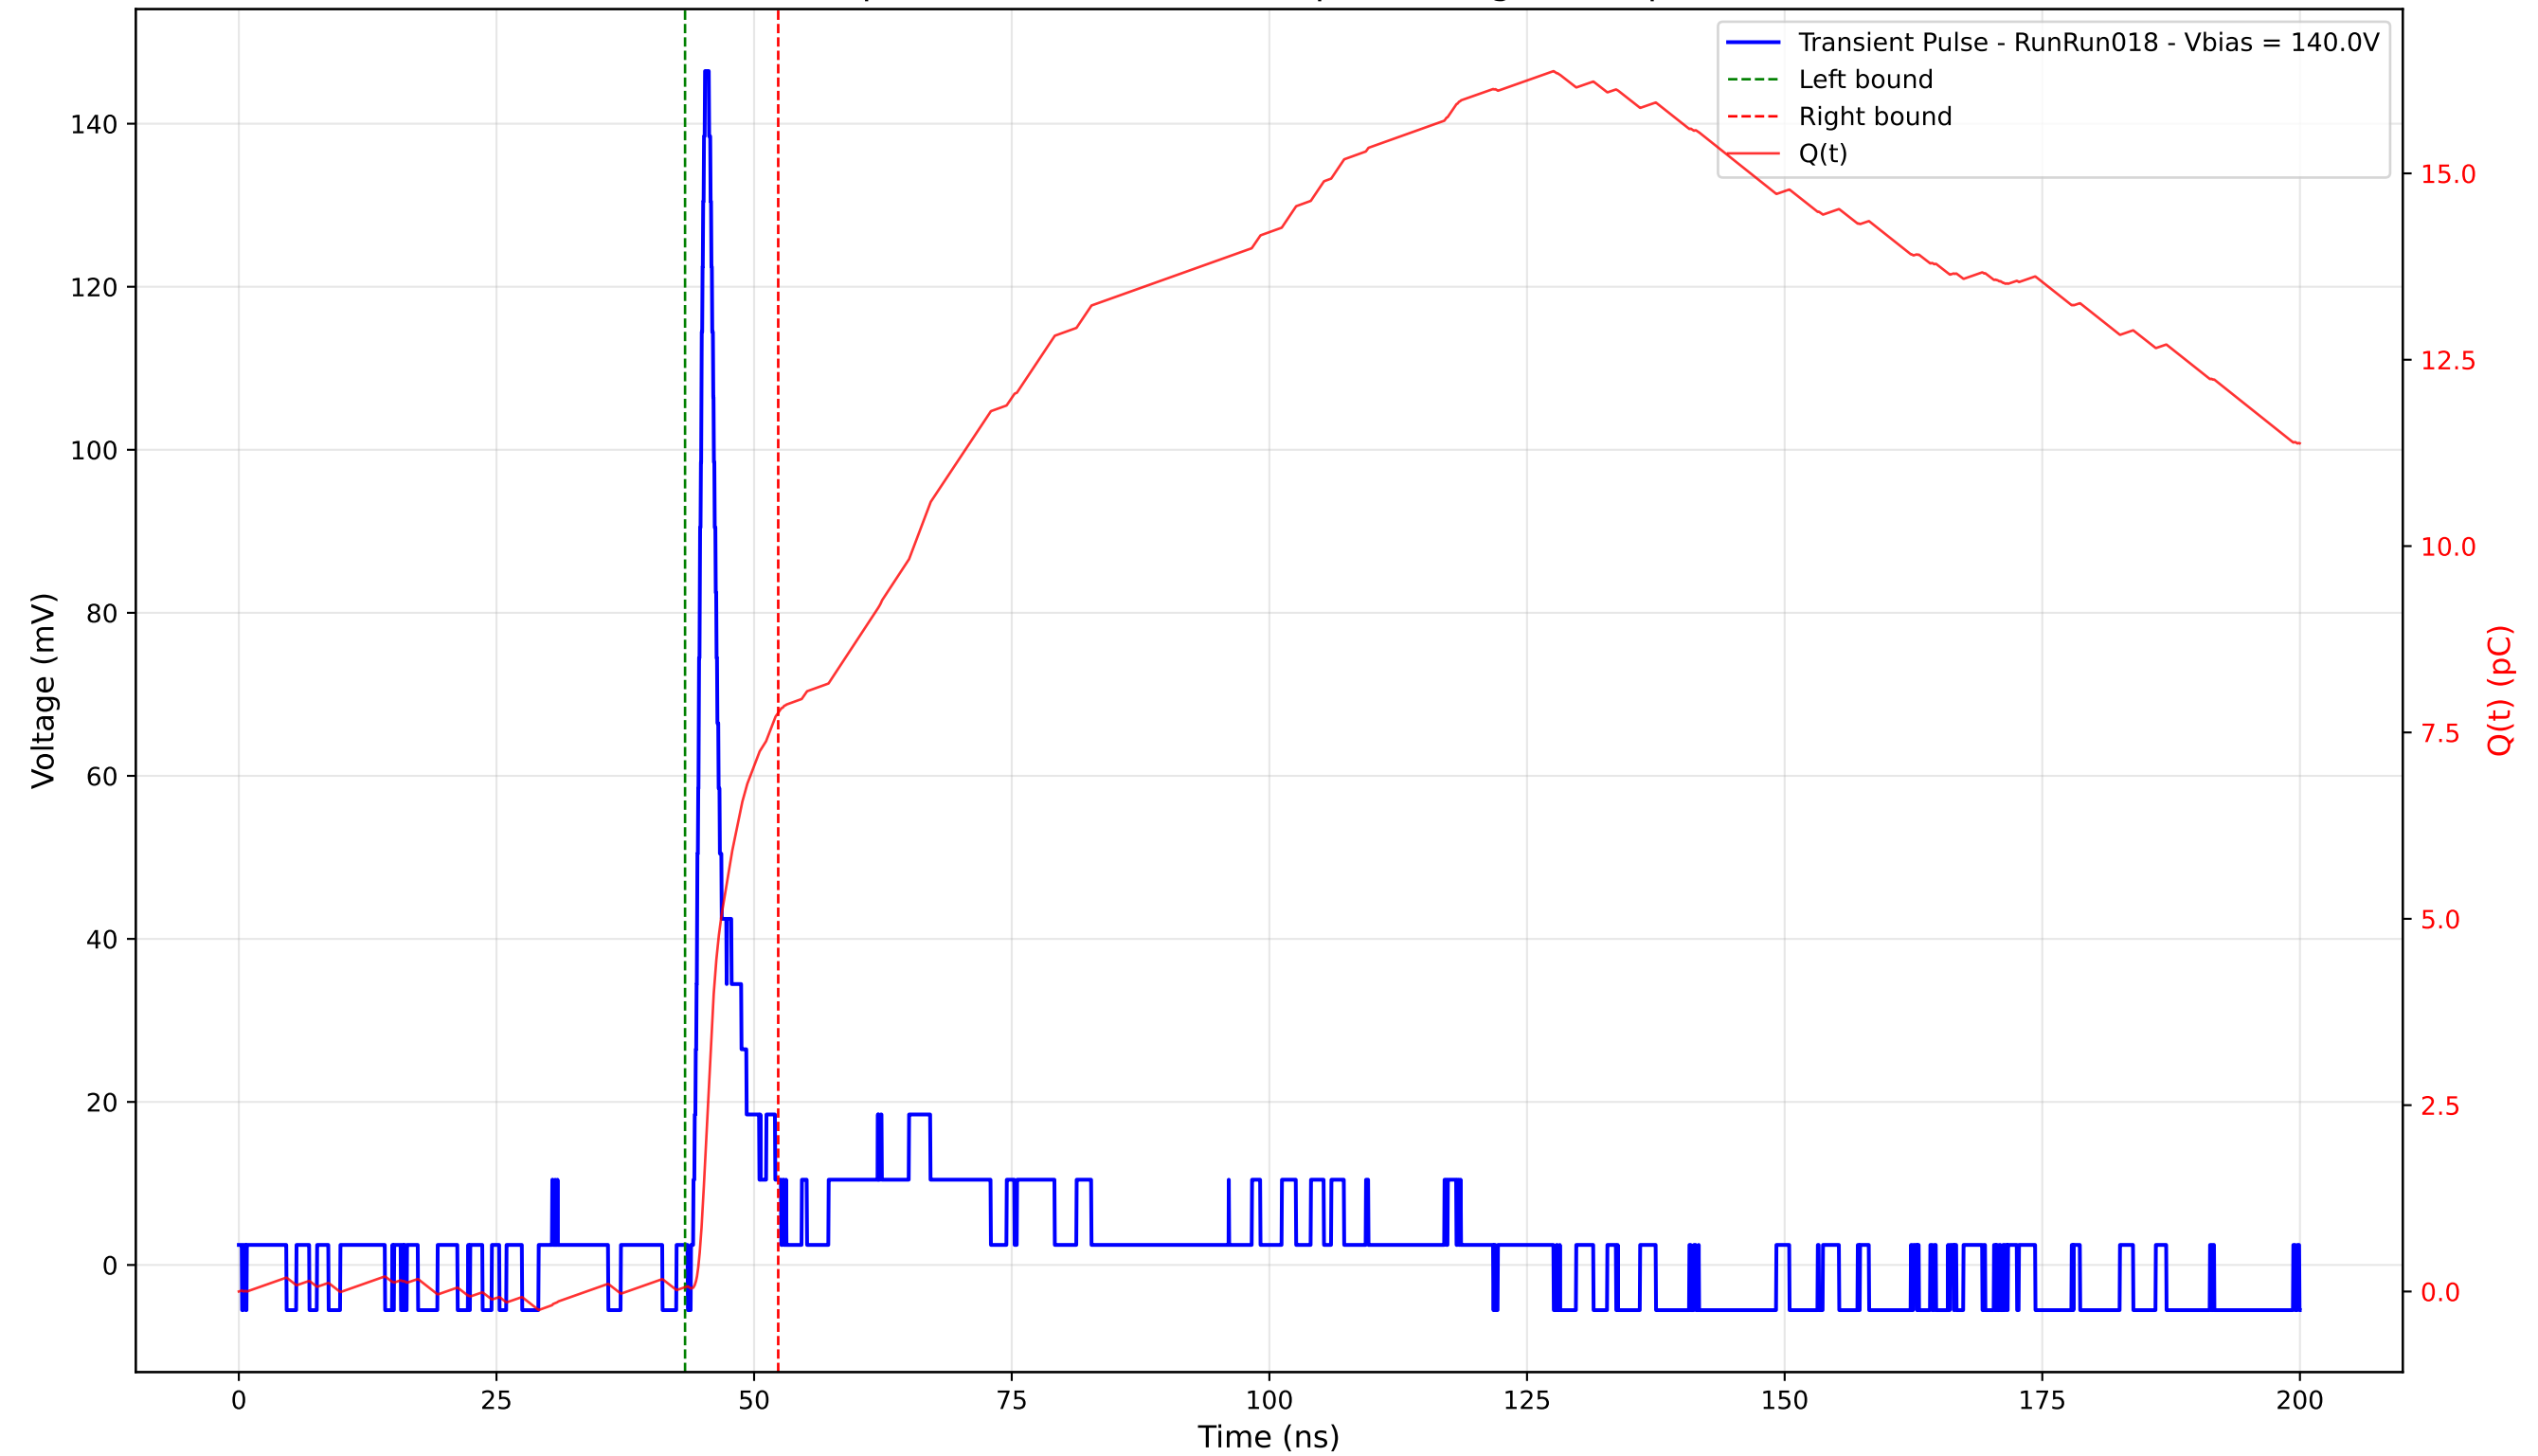


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 11.58 pC - Rise Time: 0.90 ns

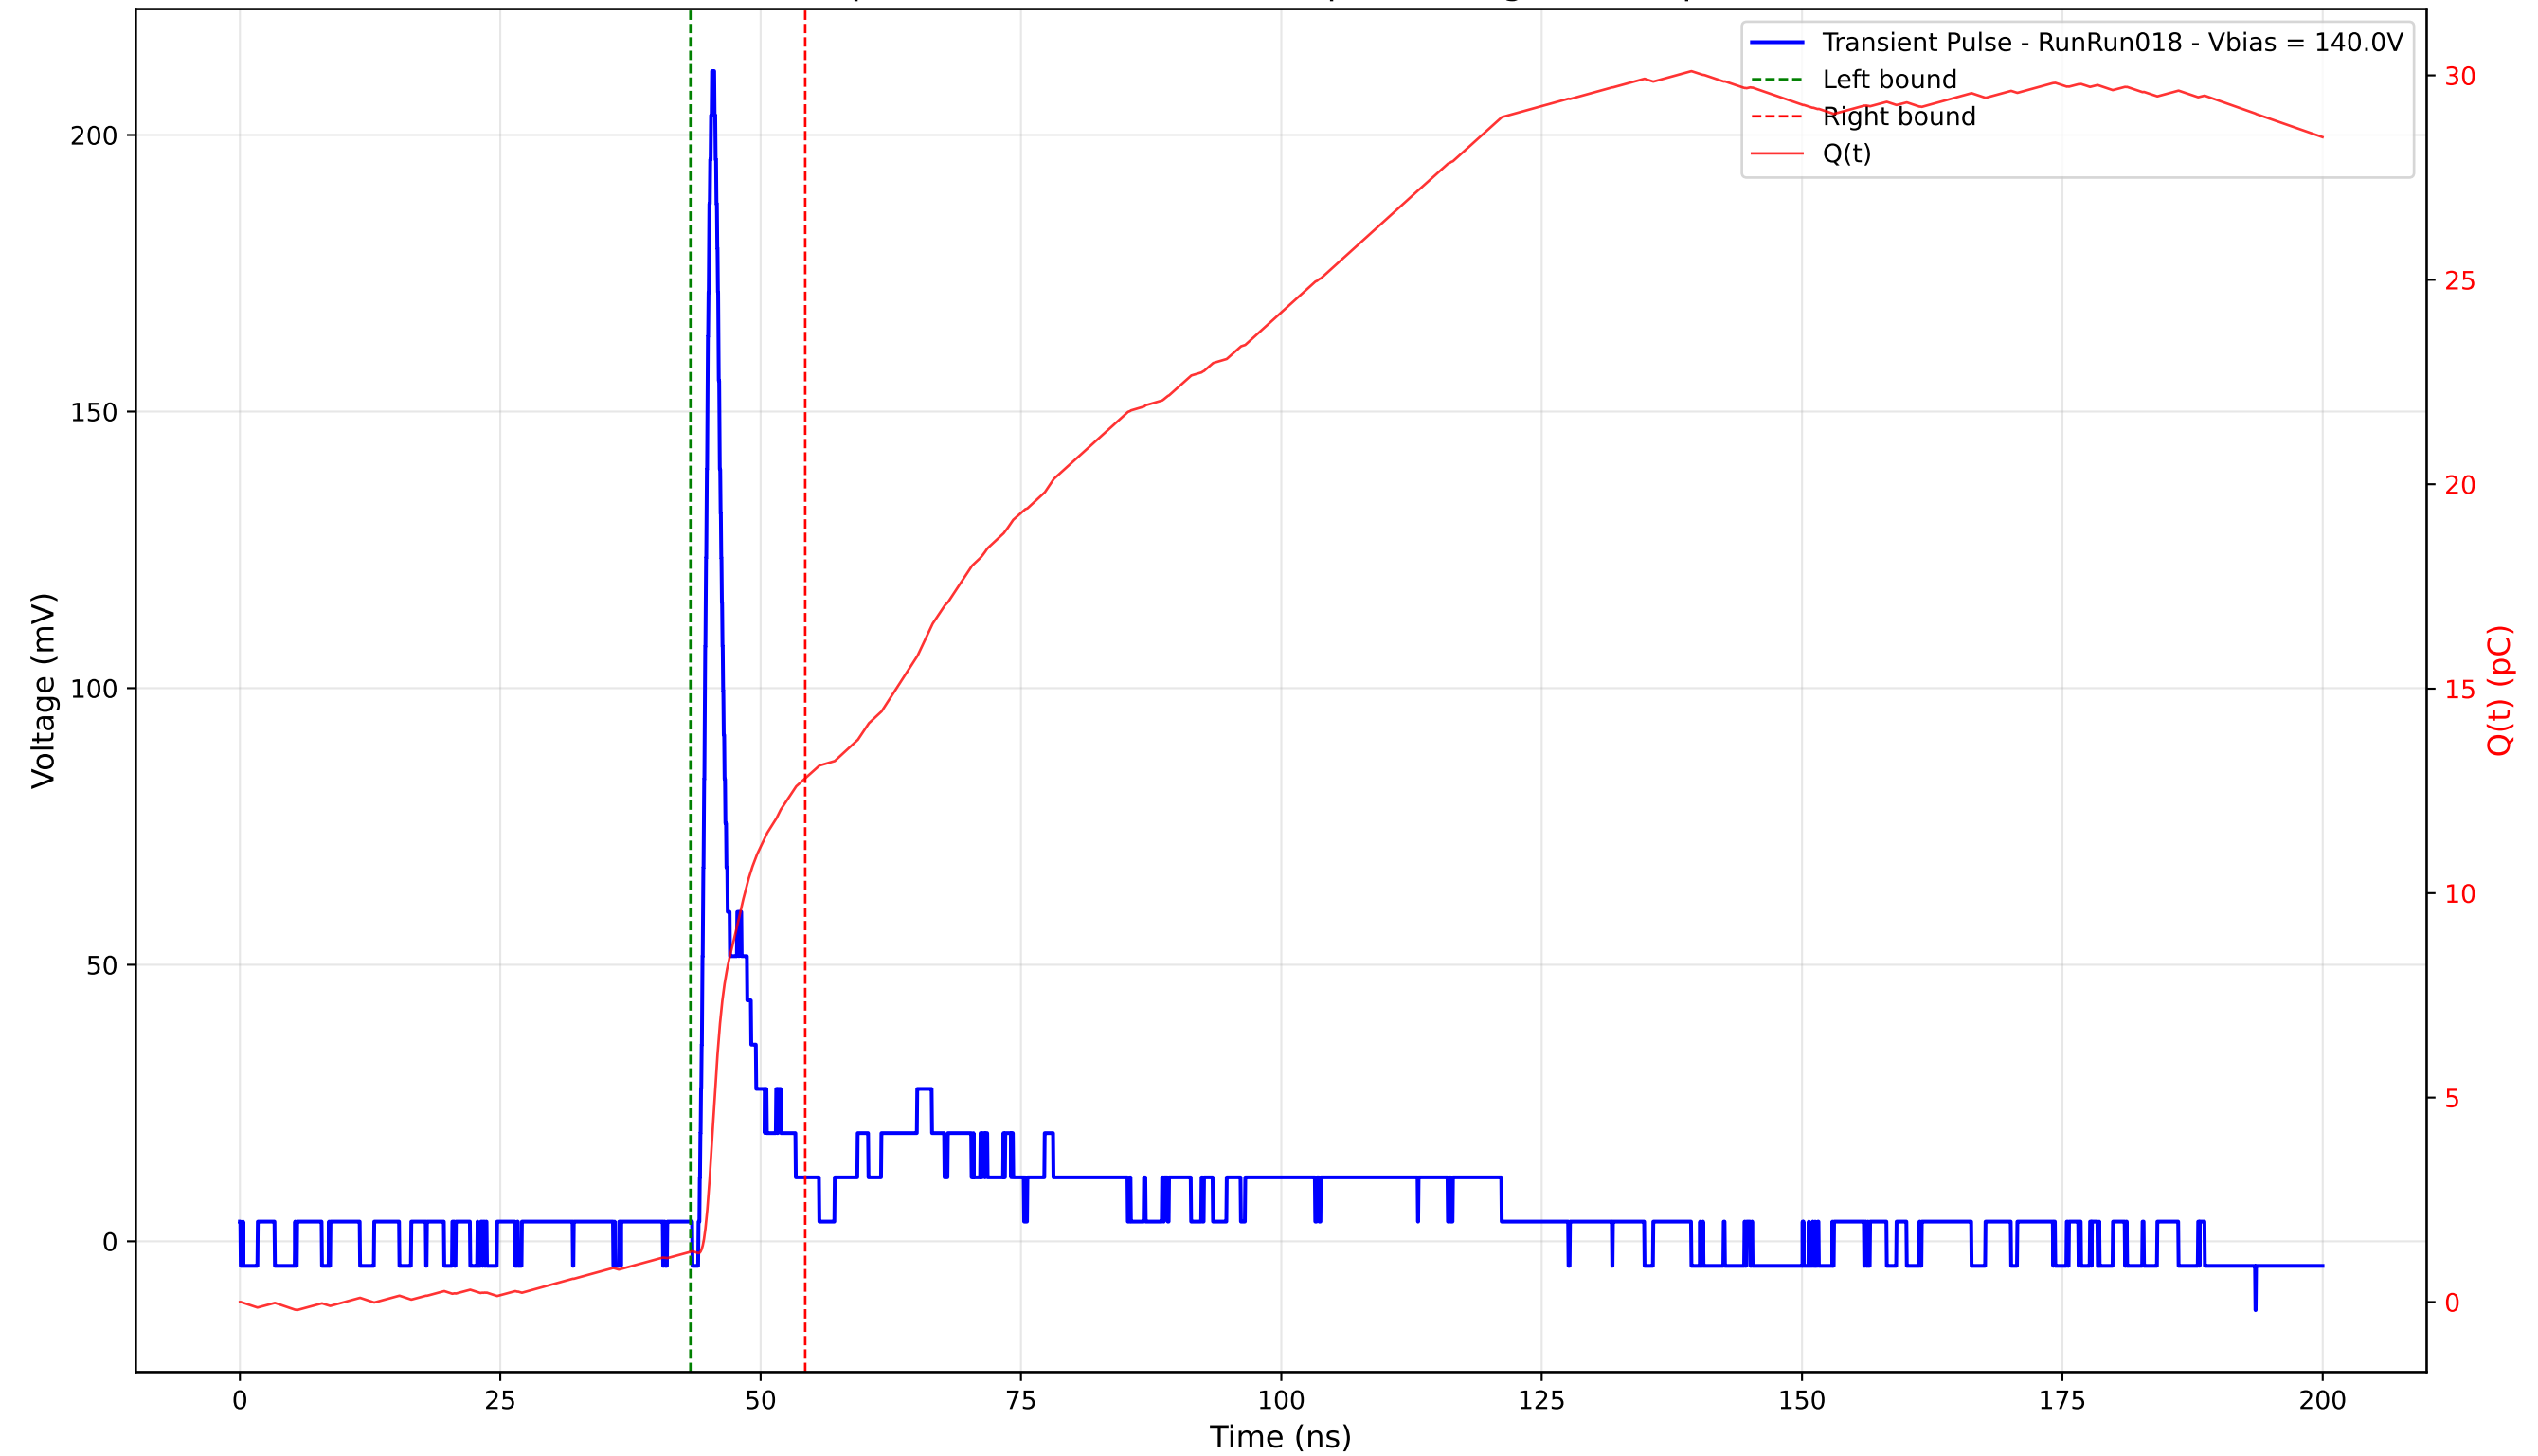


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 13.76 pC - Rise Time: 0.90 ns

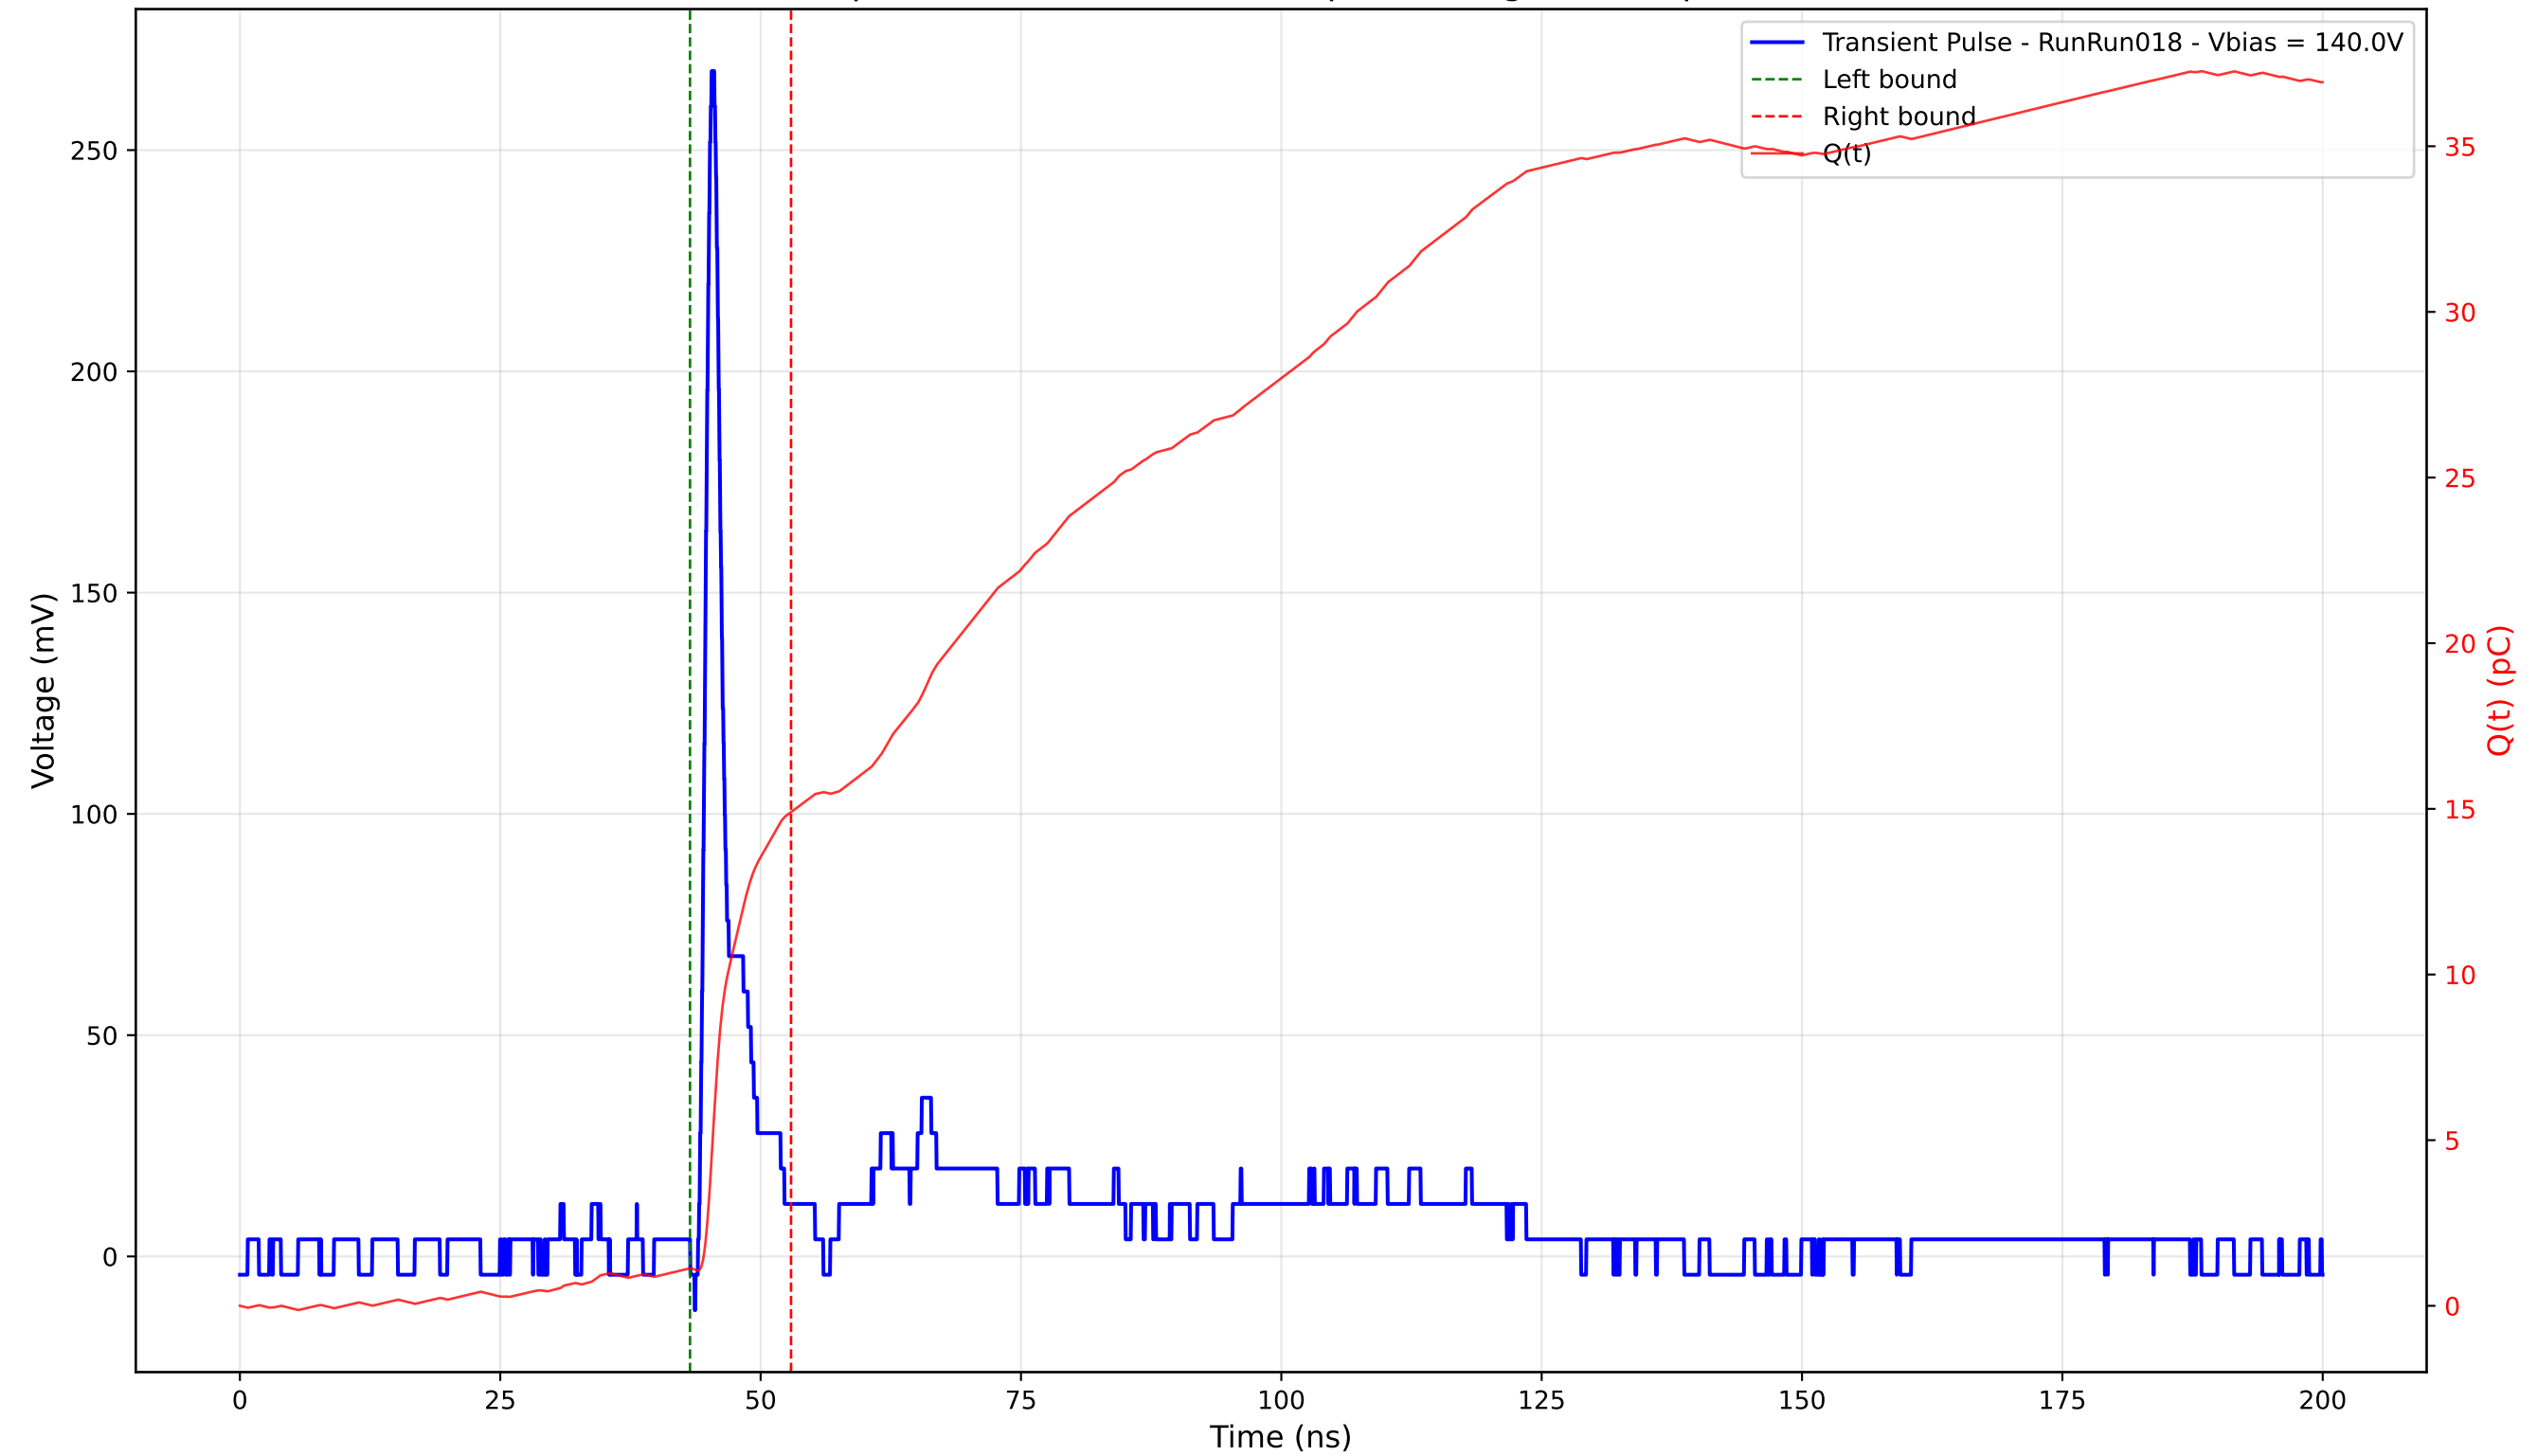


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 16.50 pC - Rise Time: 0.91 ns

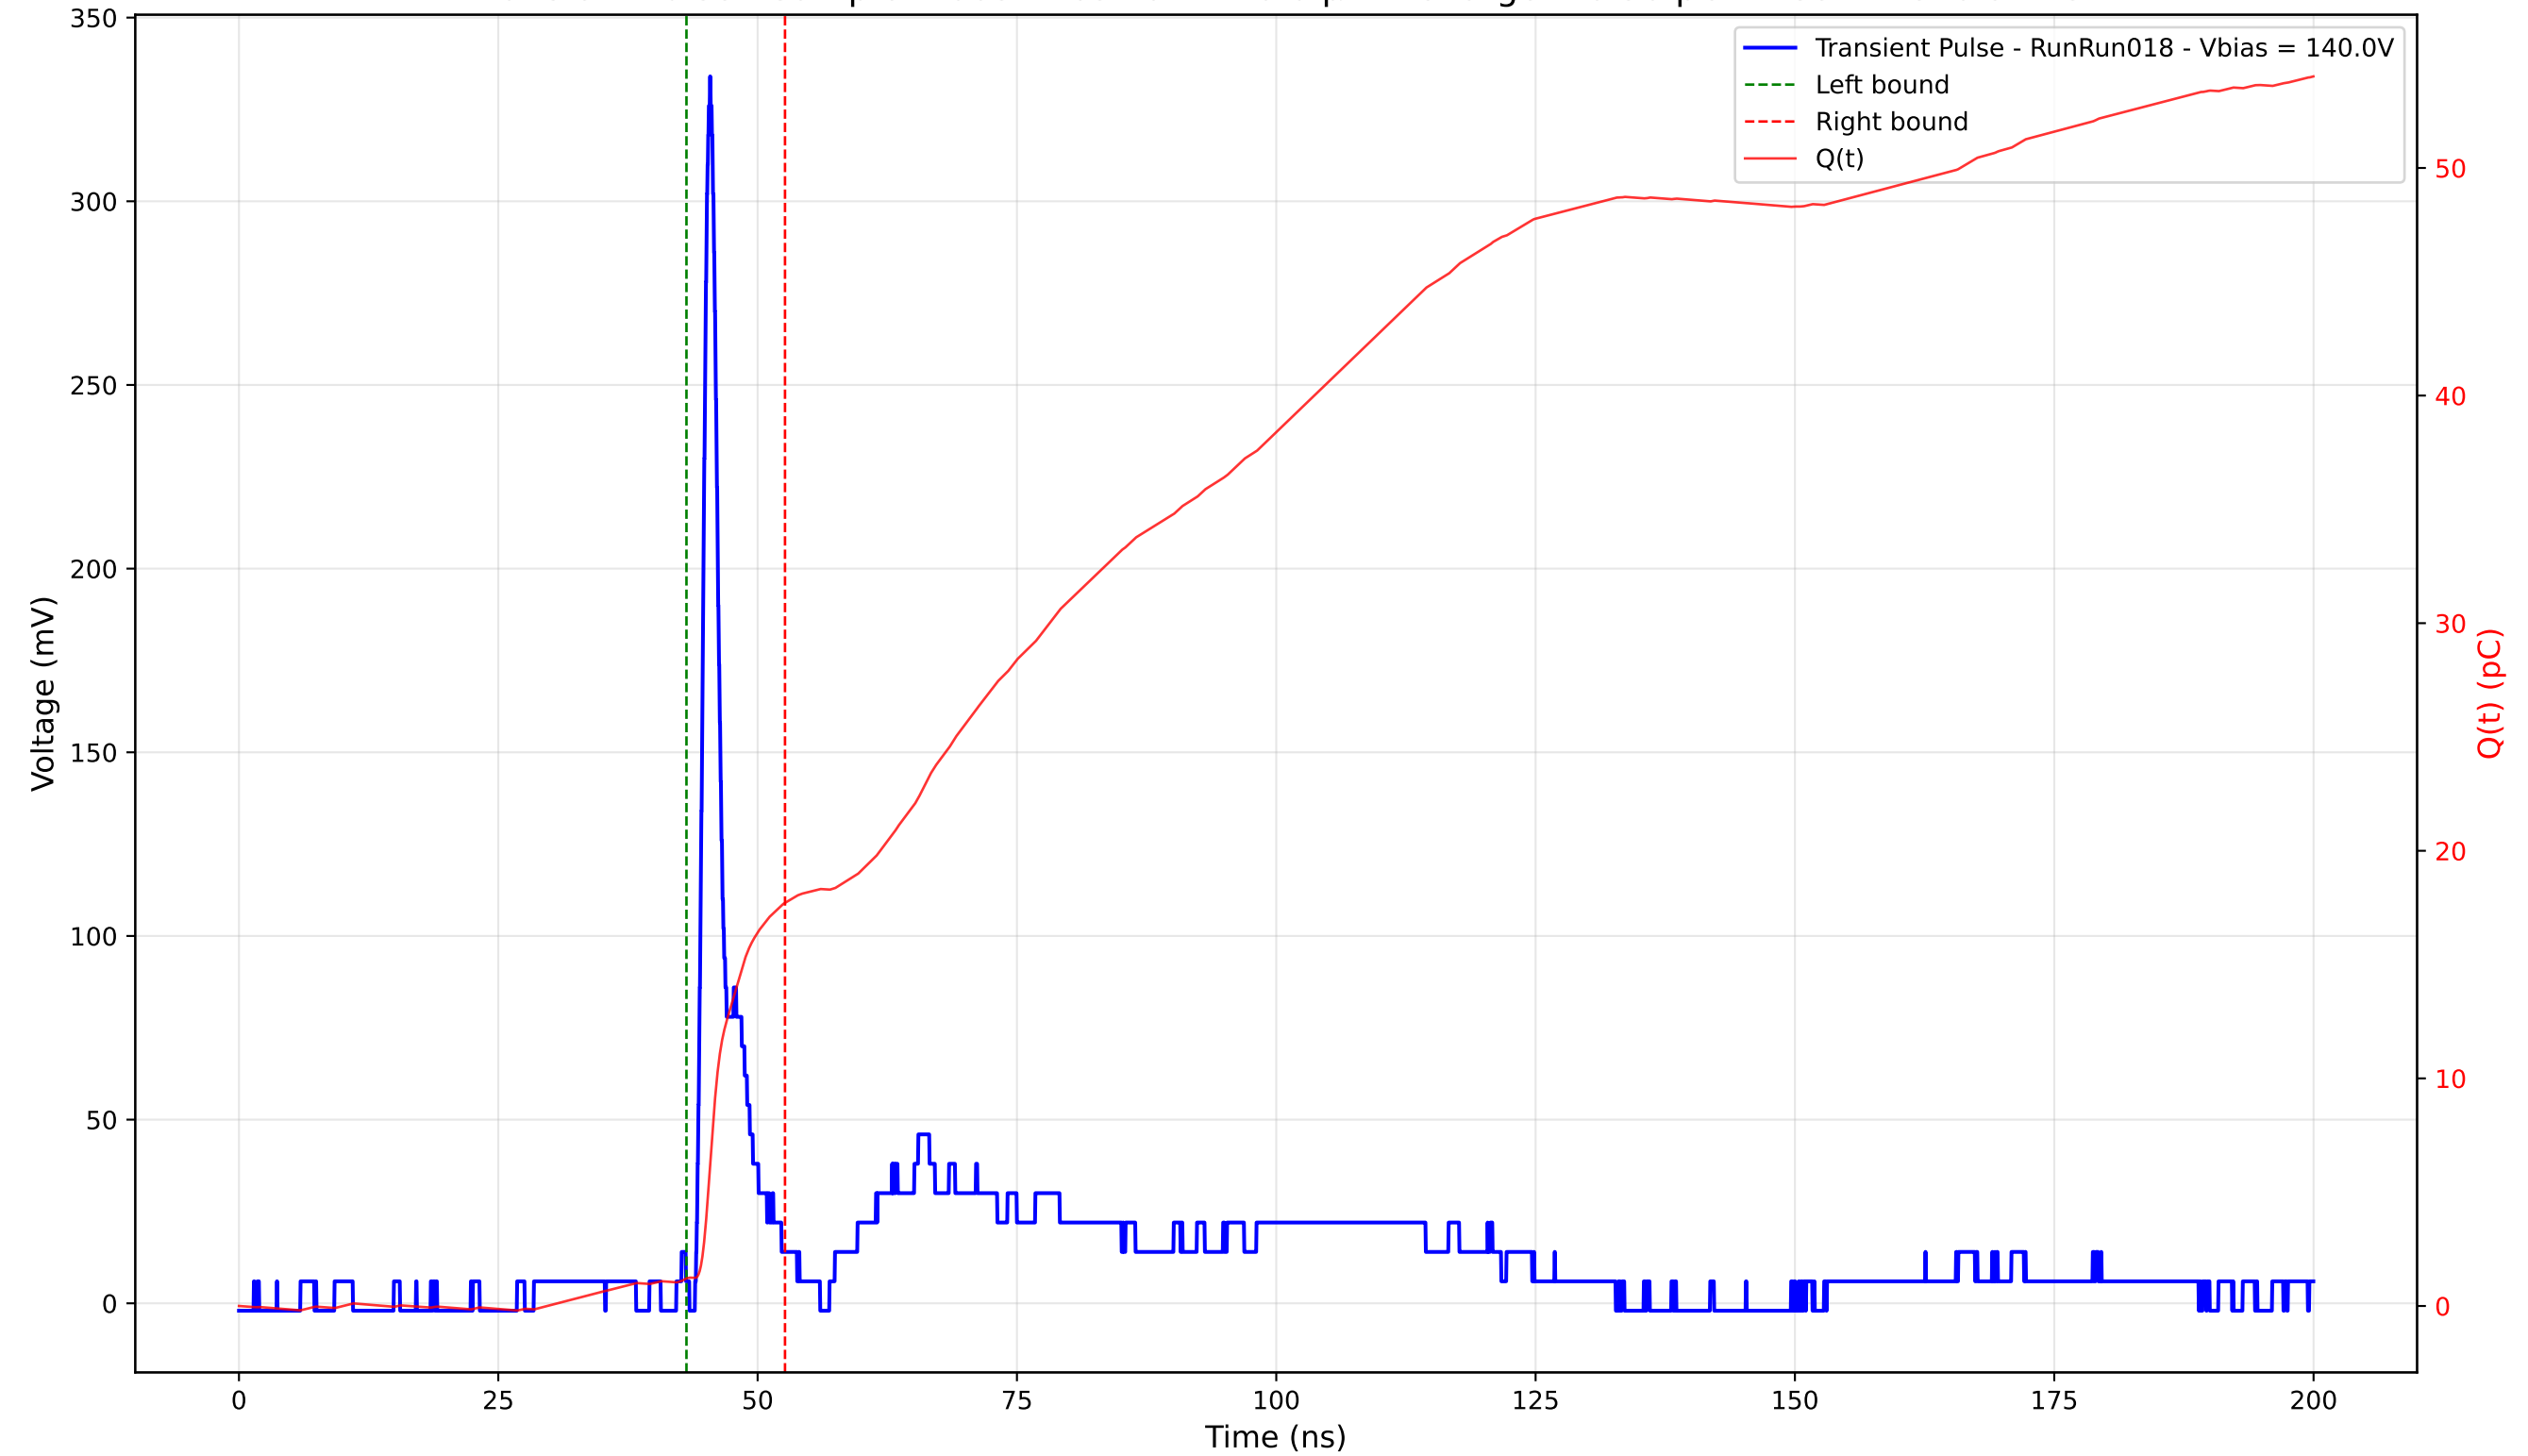


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 18.11 pC - Rise Time: 0.93 ns

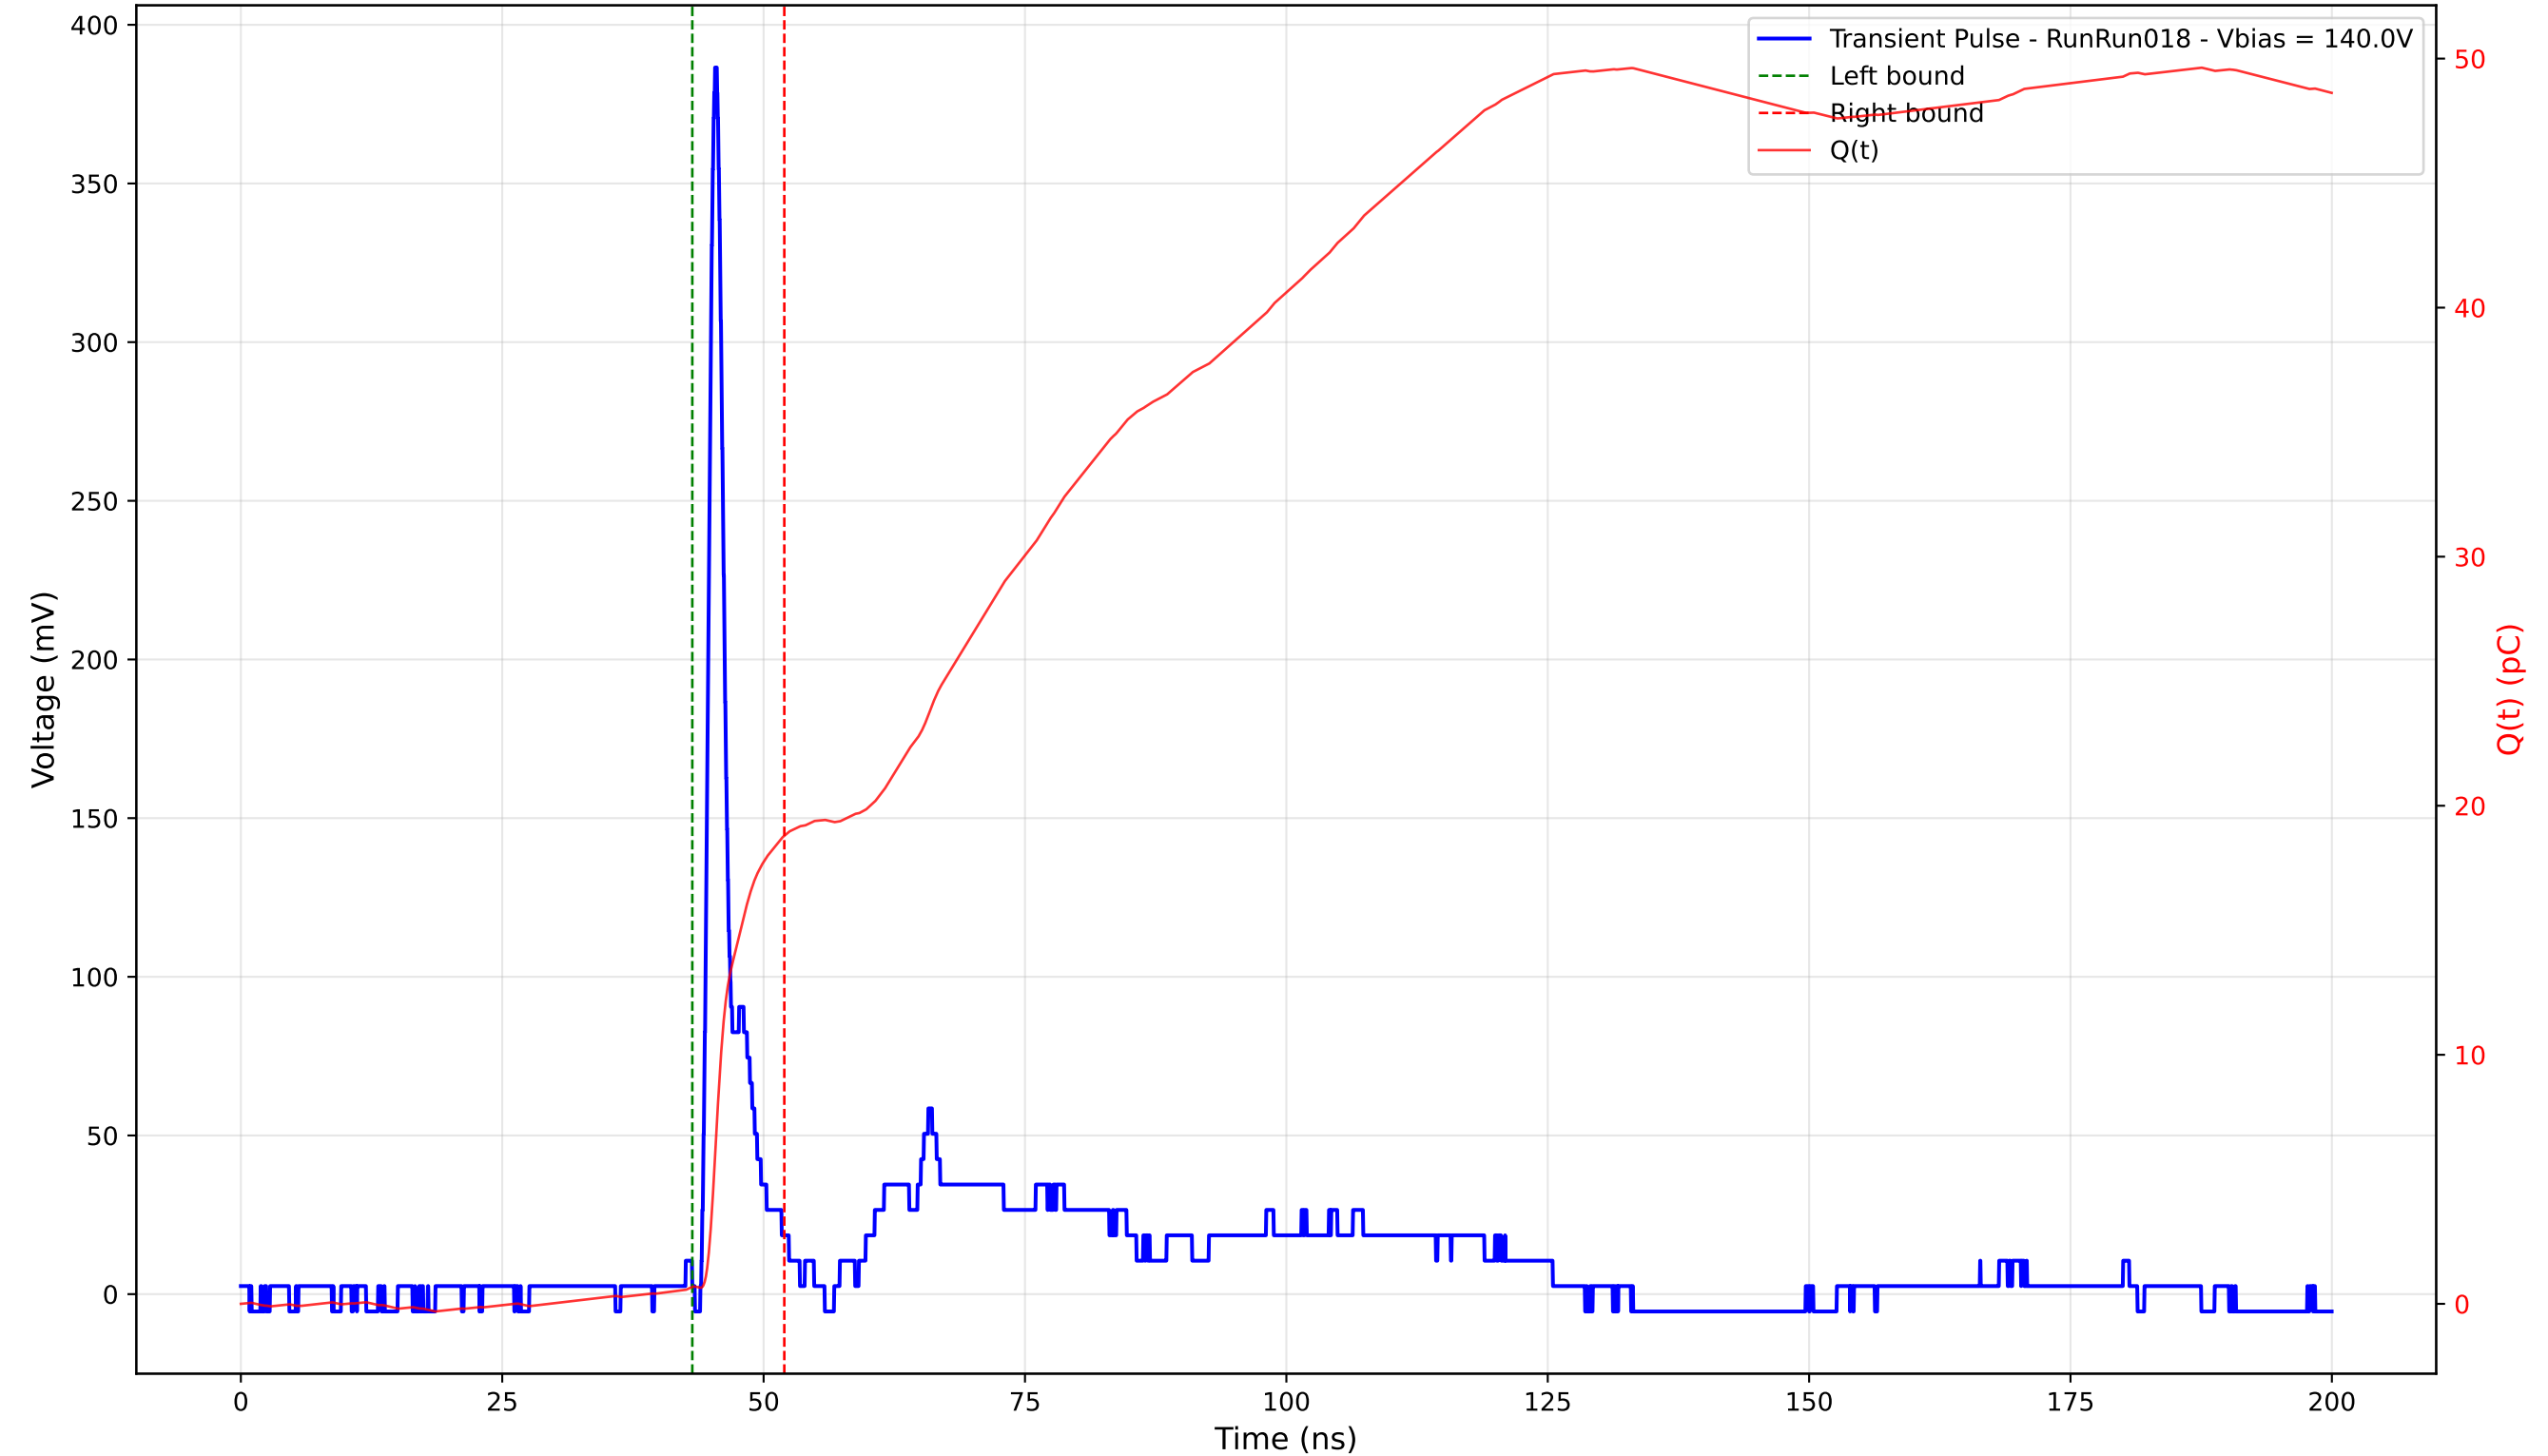


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 19.41 pC - Rise Time: 0.87 ns

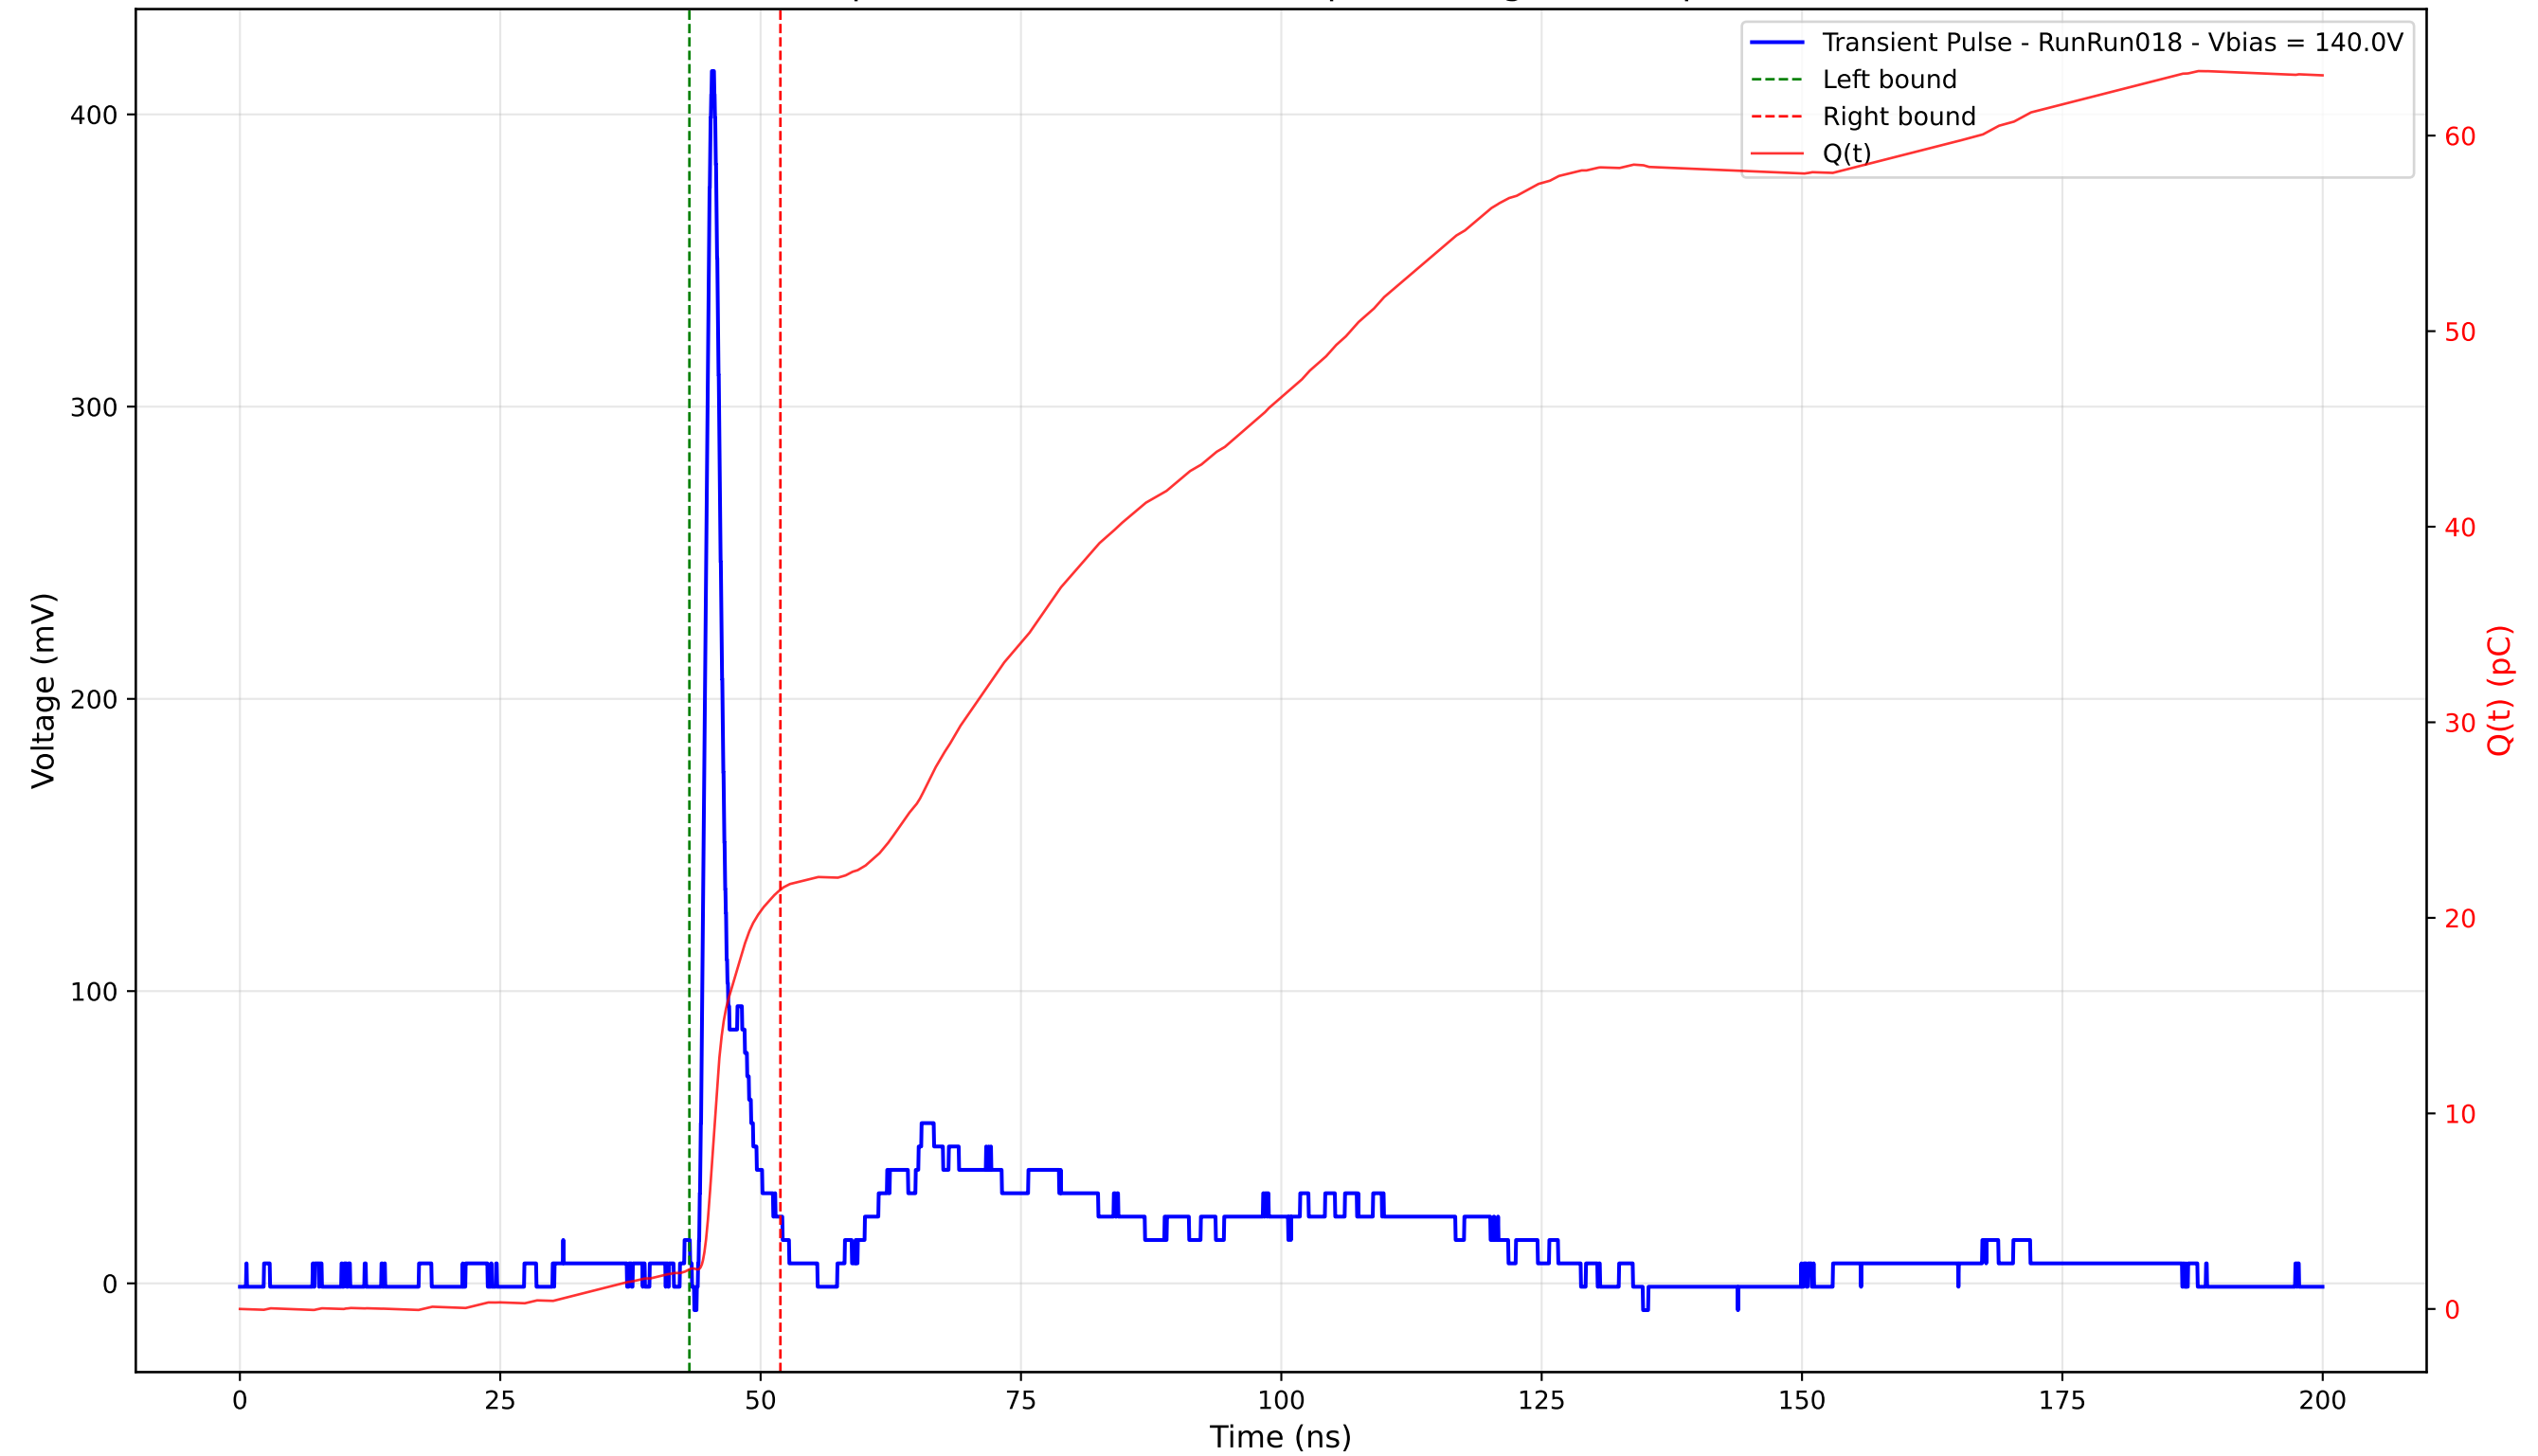


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 19.98 pC - Rise Time: 0.92 ns

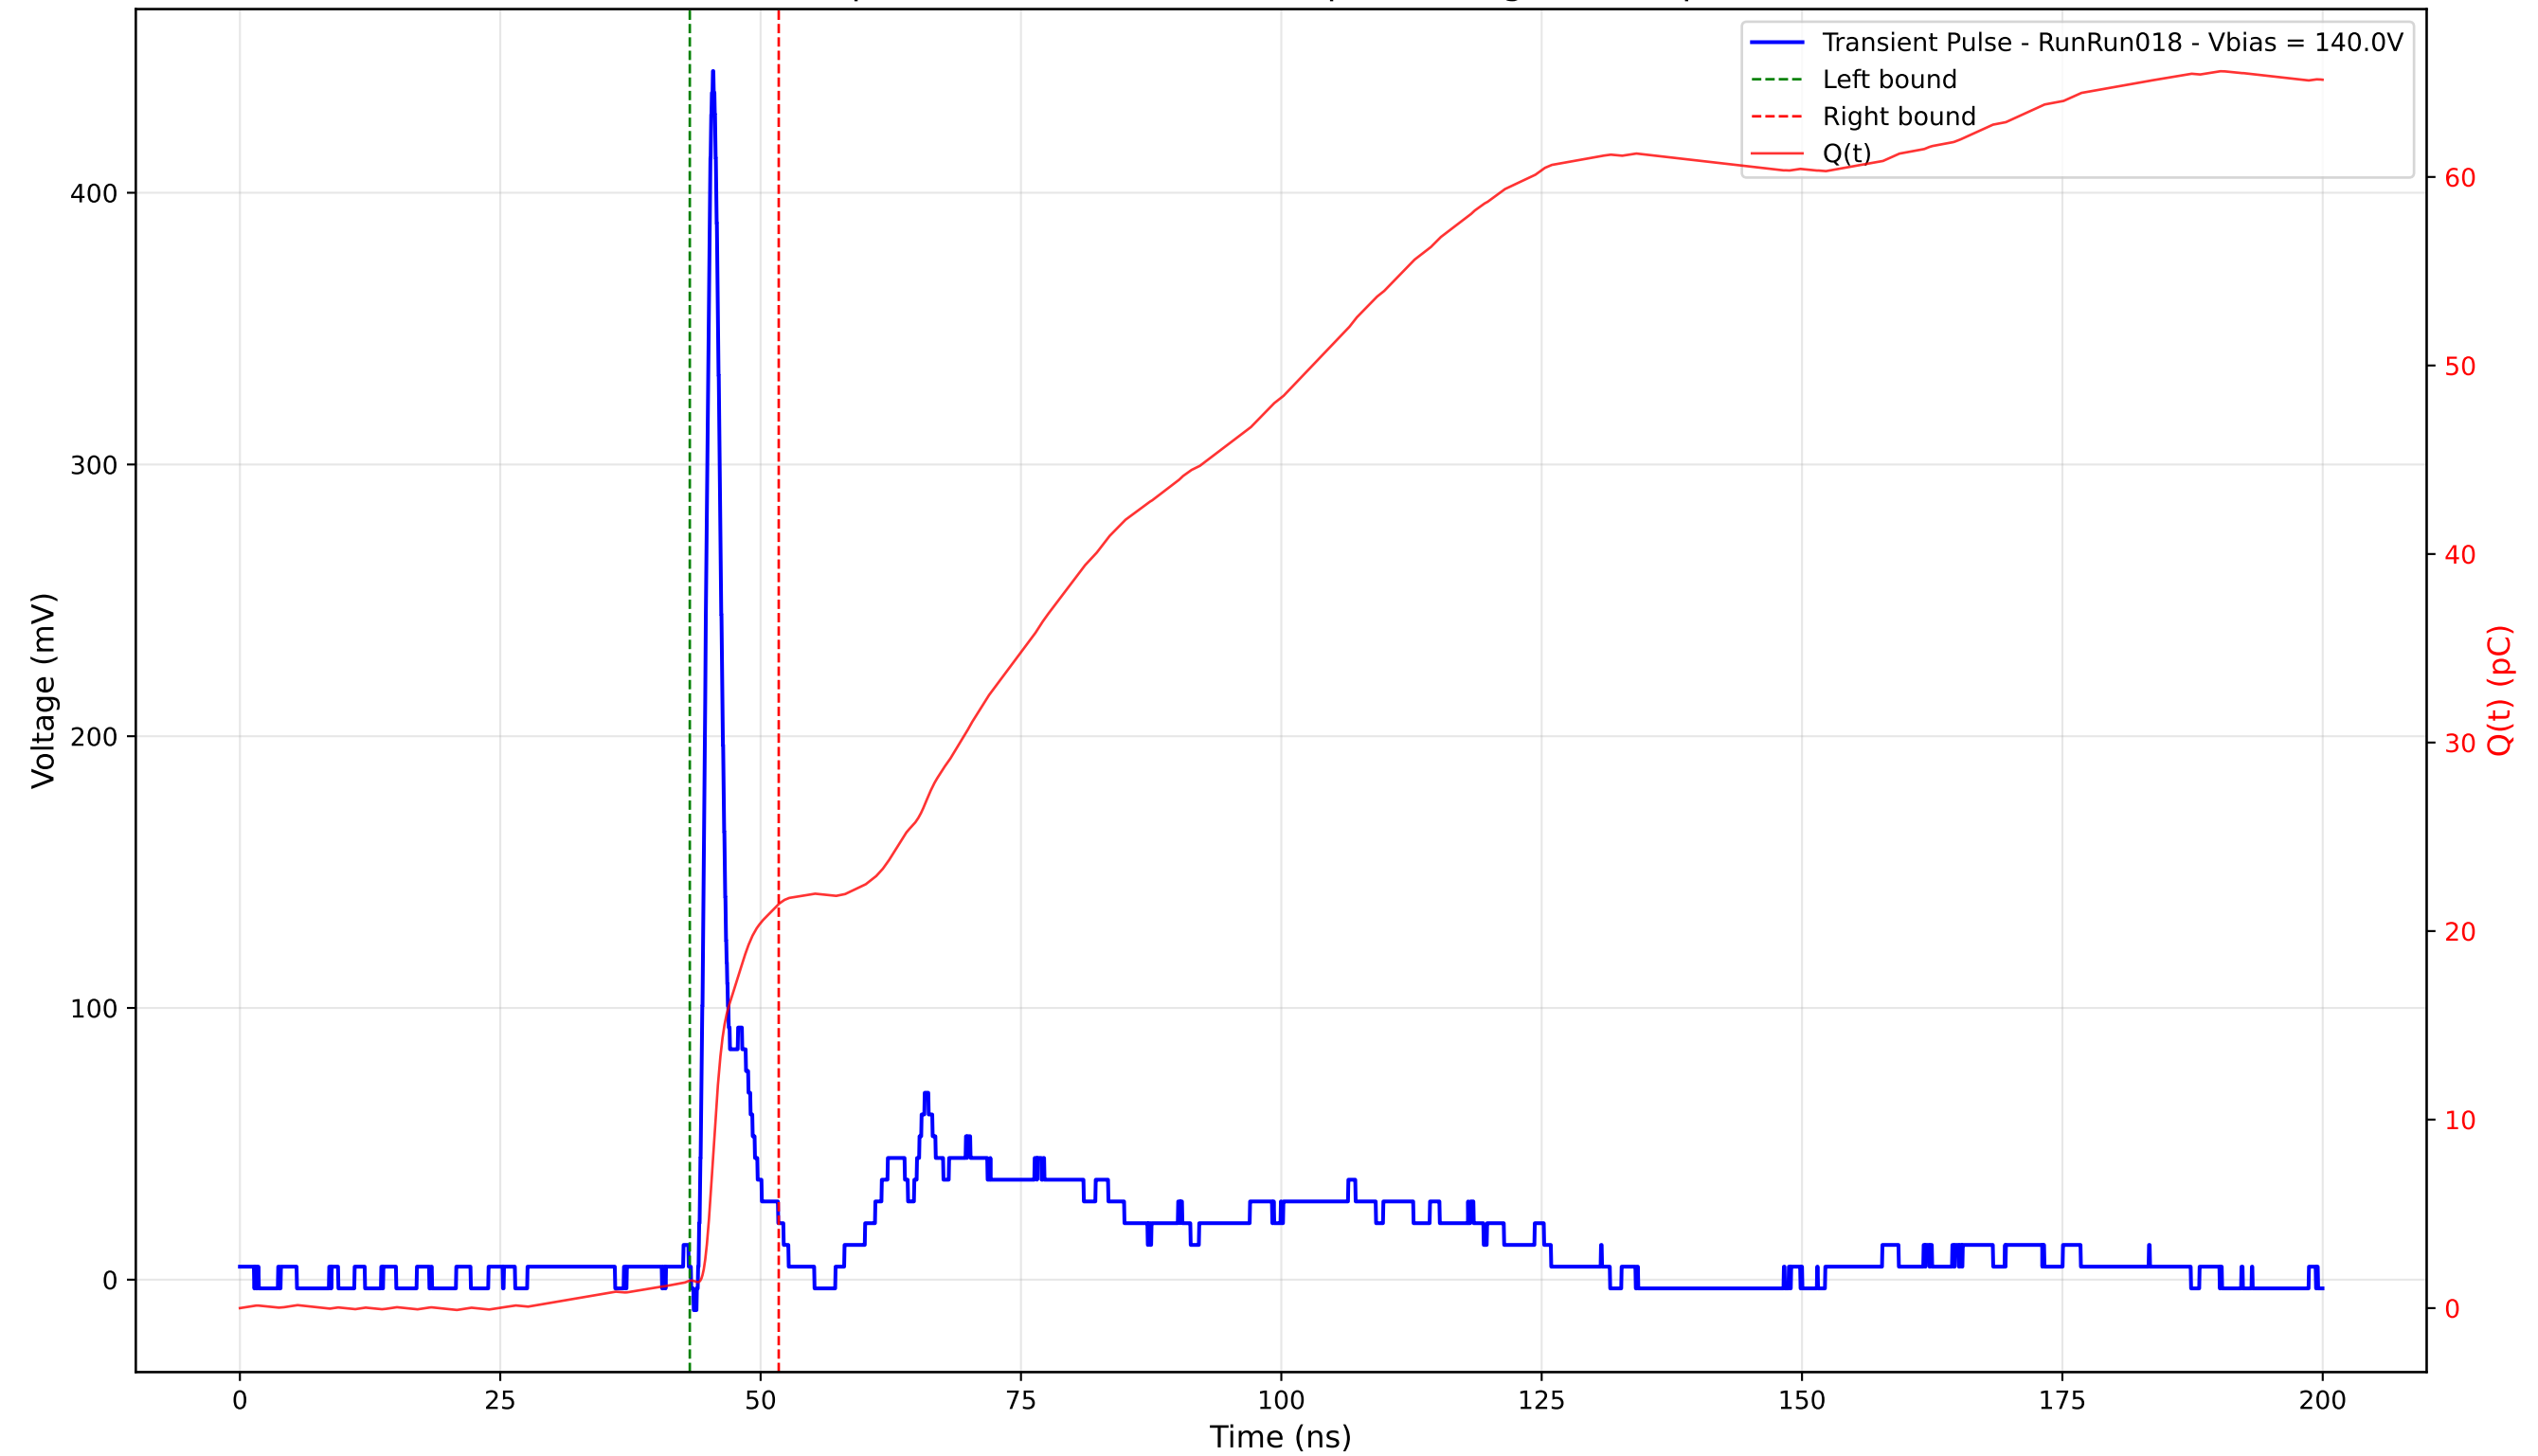


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 20.16 pC - Rise Time: 0.92 ns

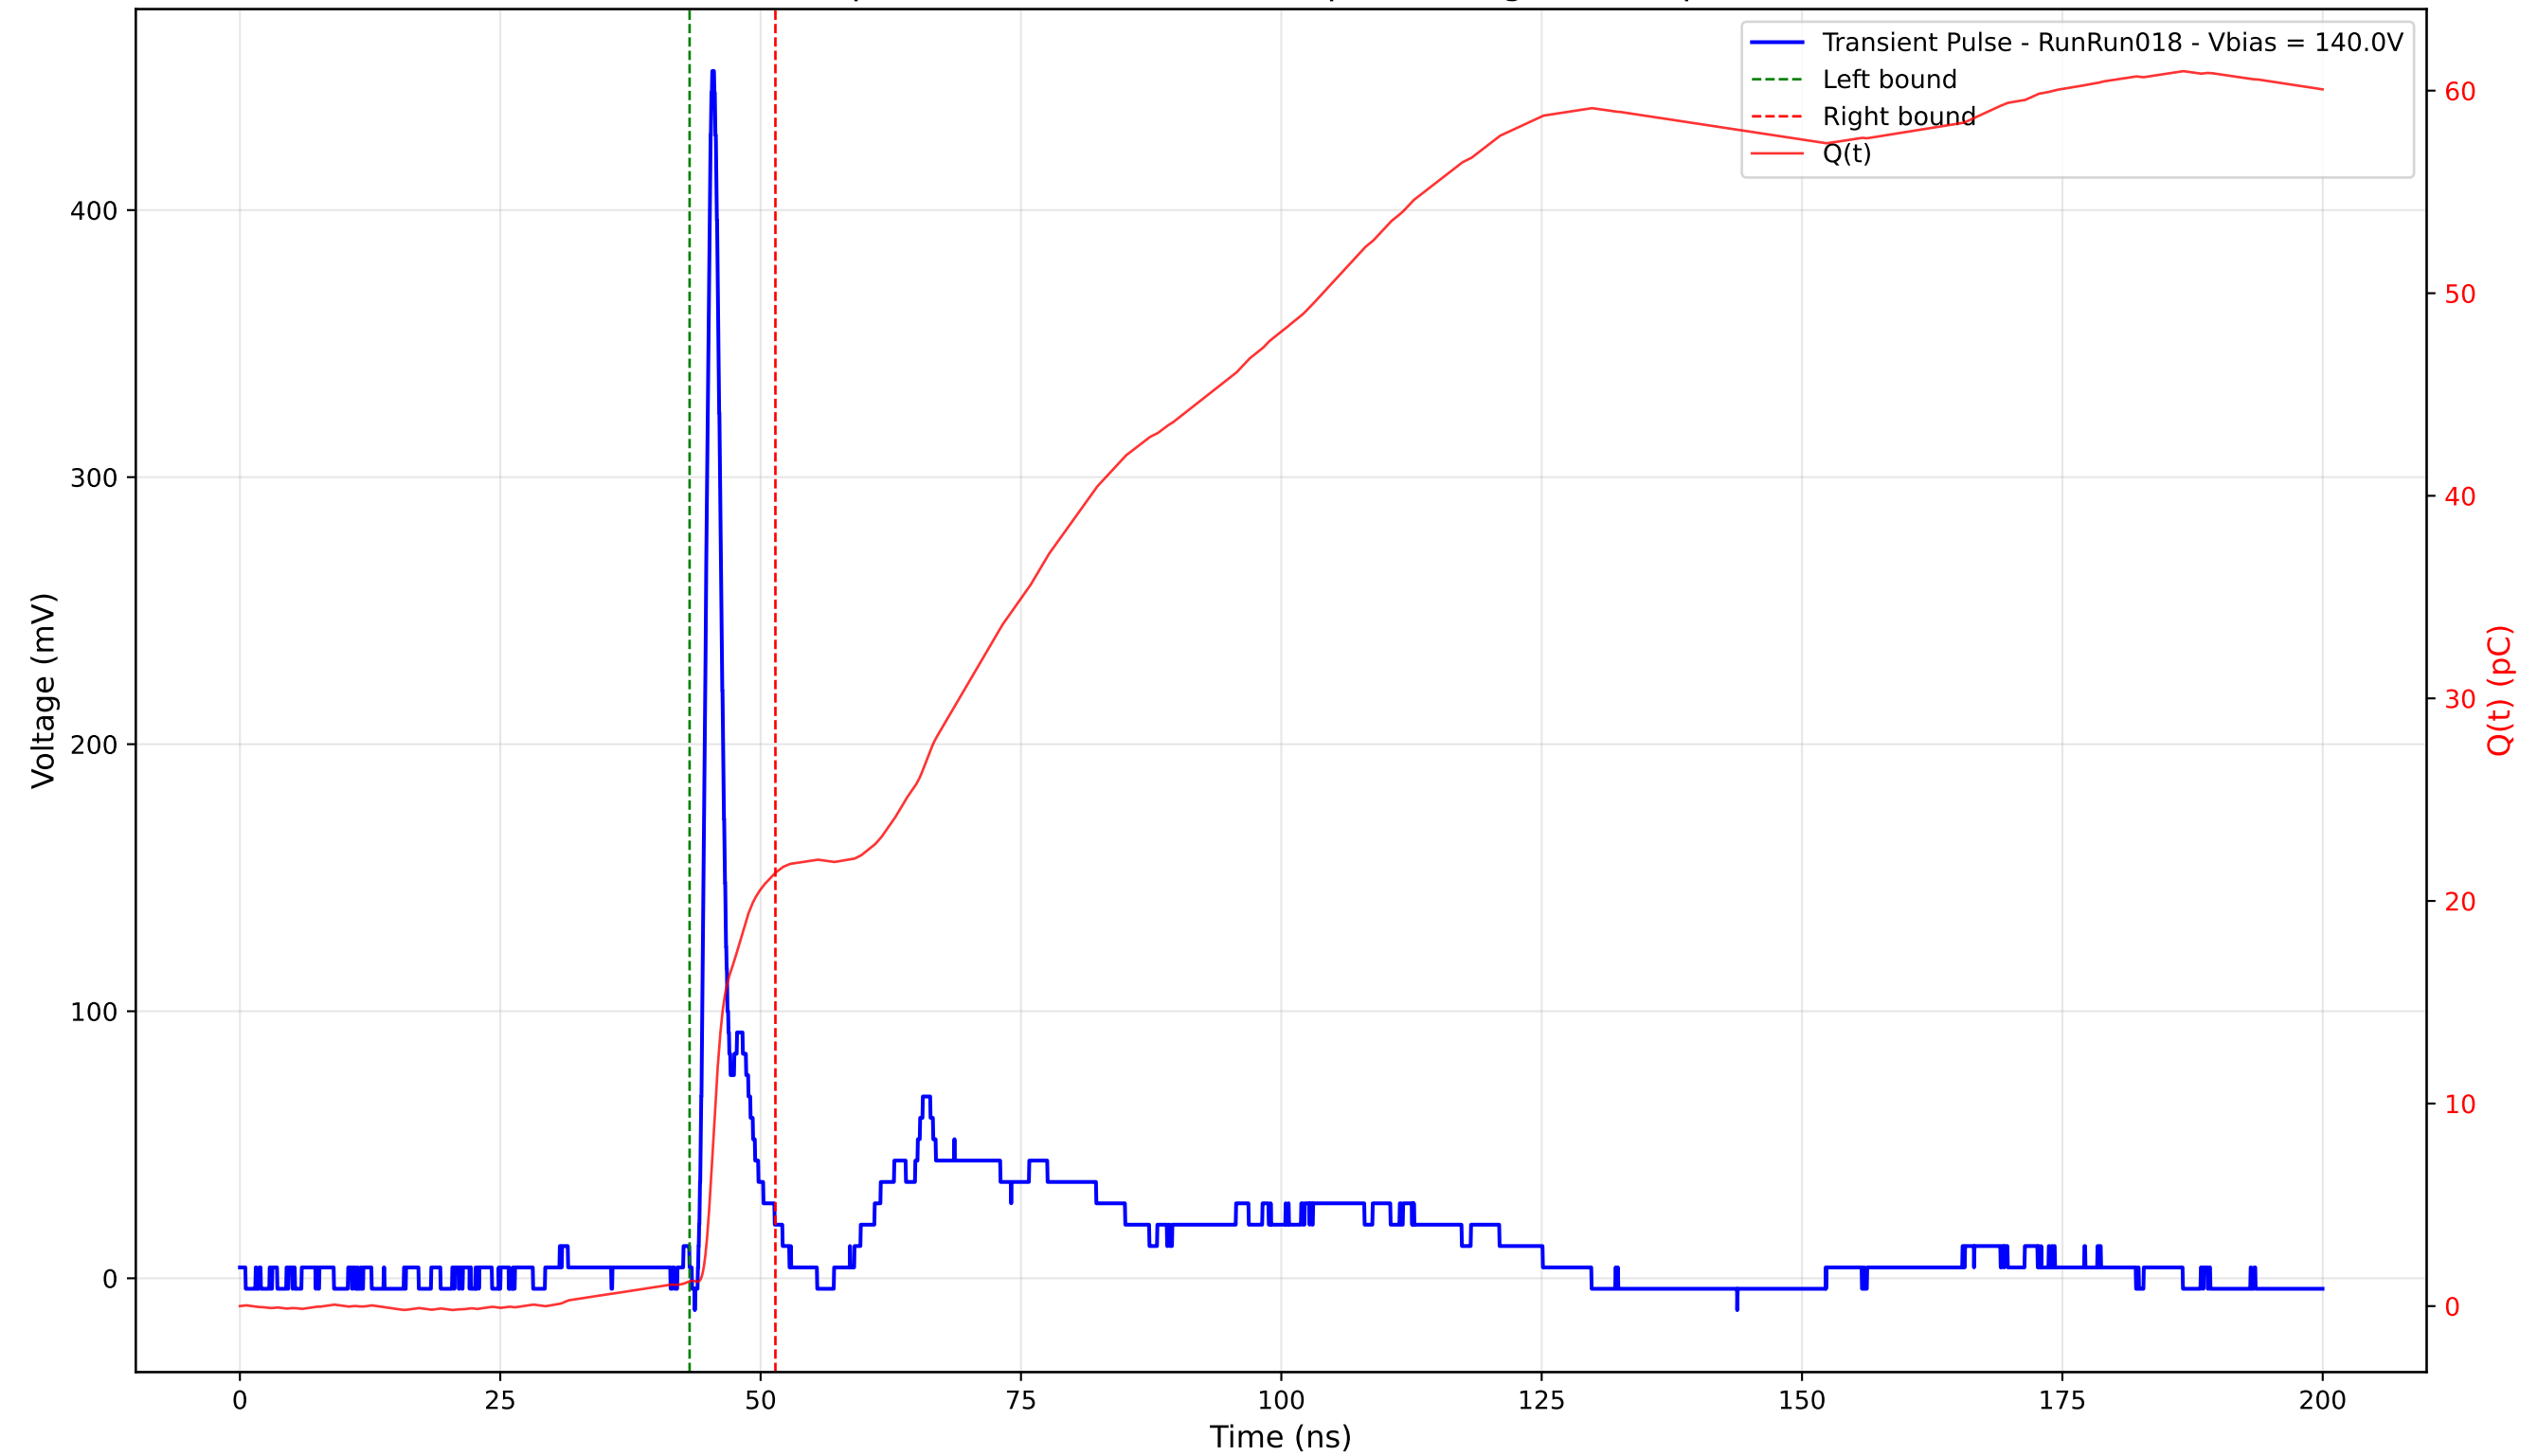


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 20.22 pC - Rise Time: 0.91 ns

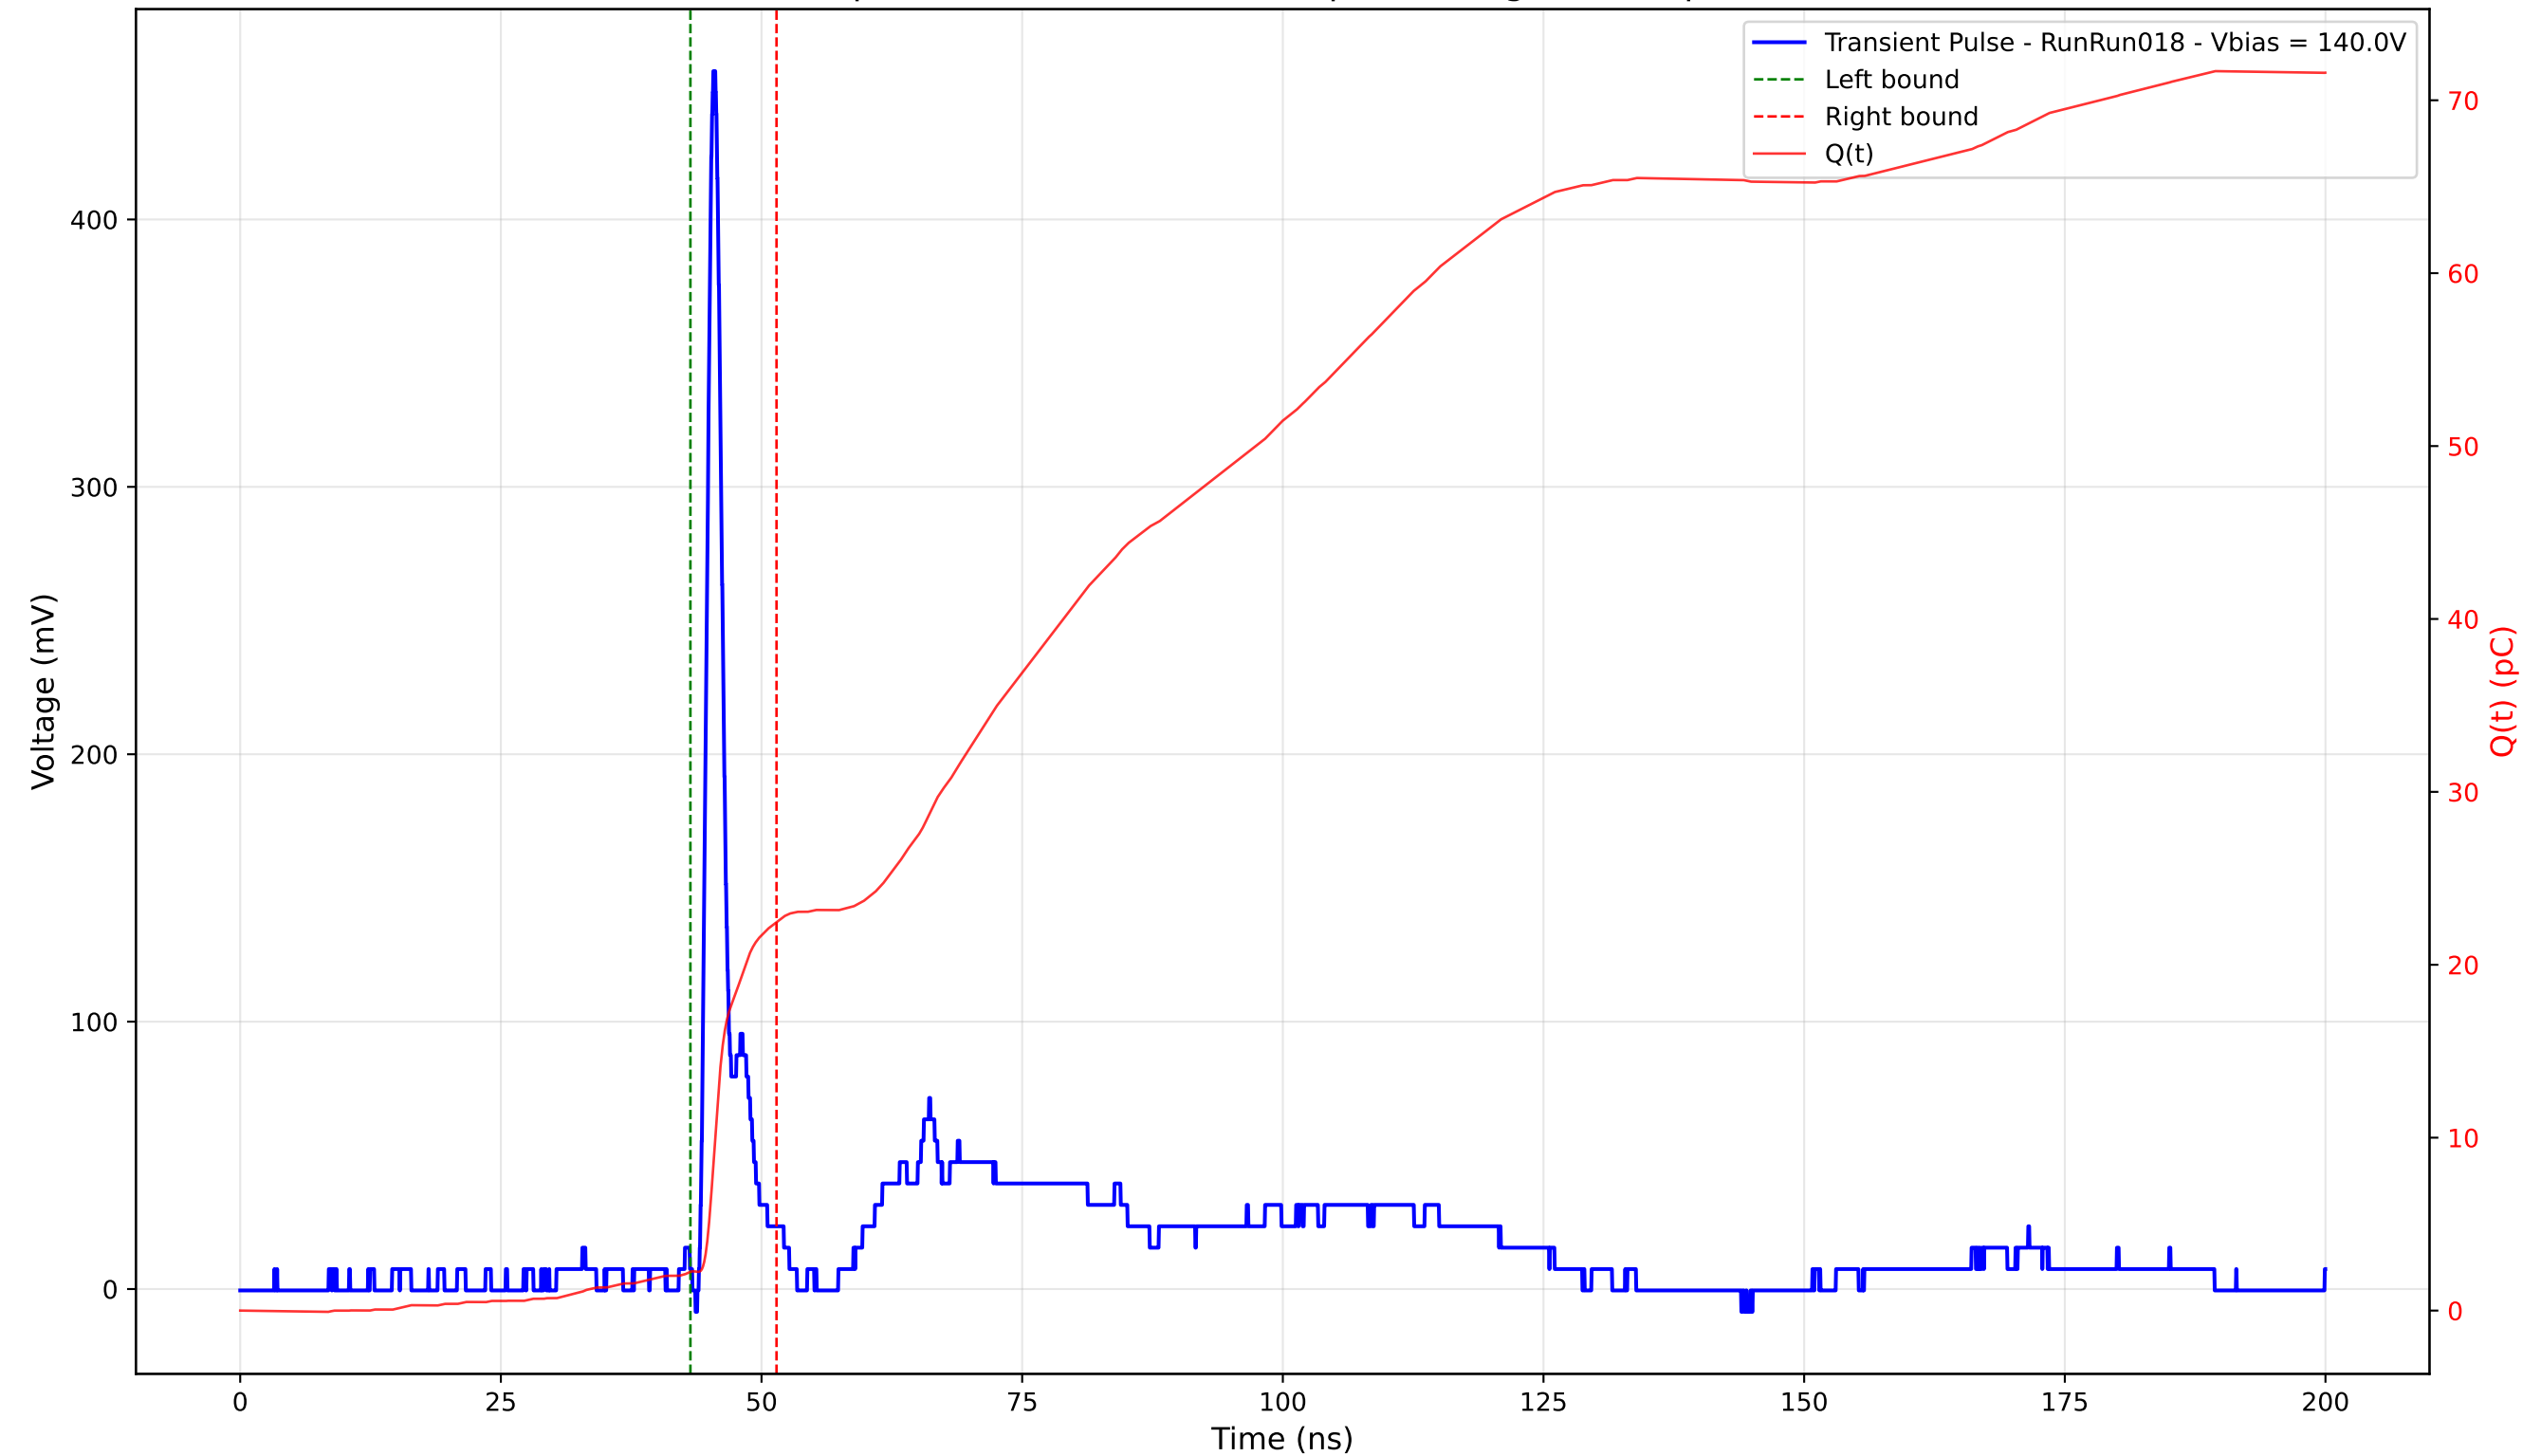


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 19.46 pC - Rise Time: 0.92 ns

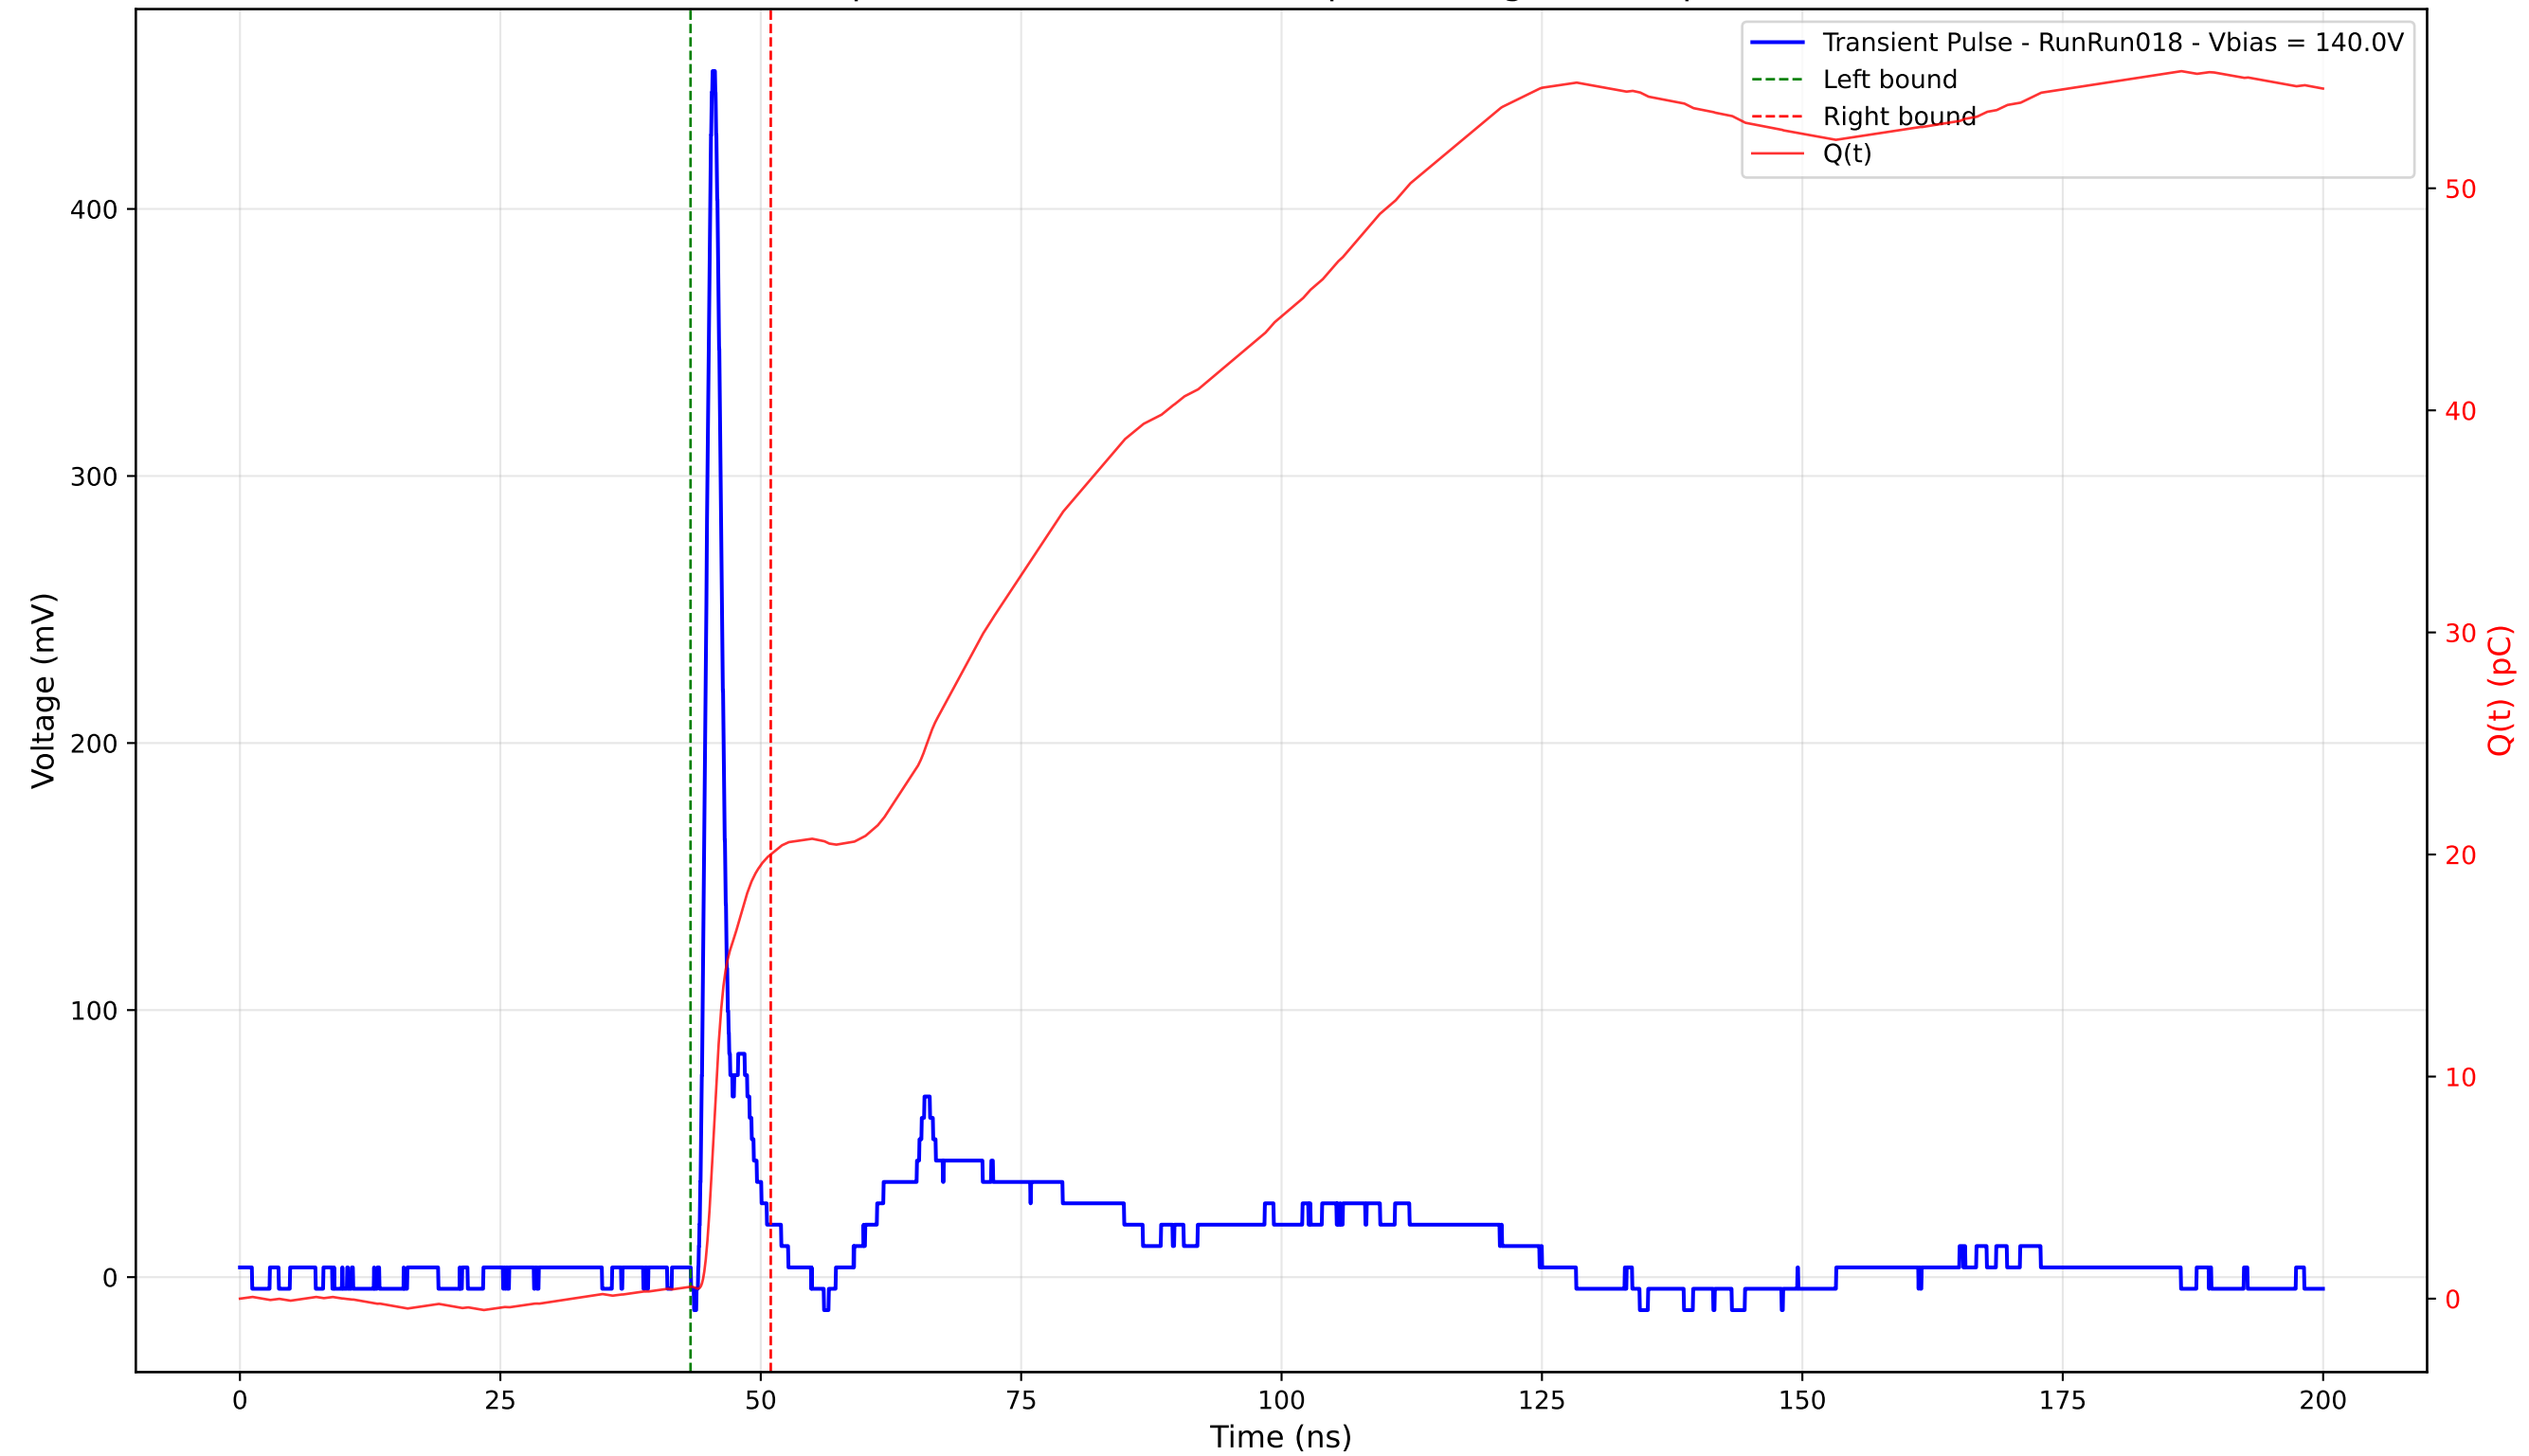


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 19.40 pC - Rise Time: 0.95 ns

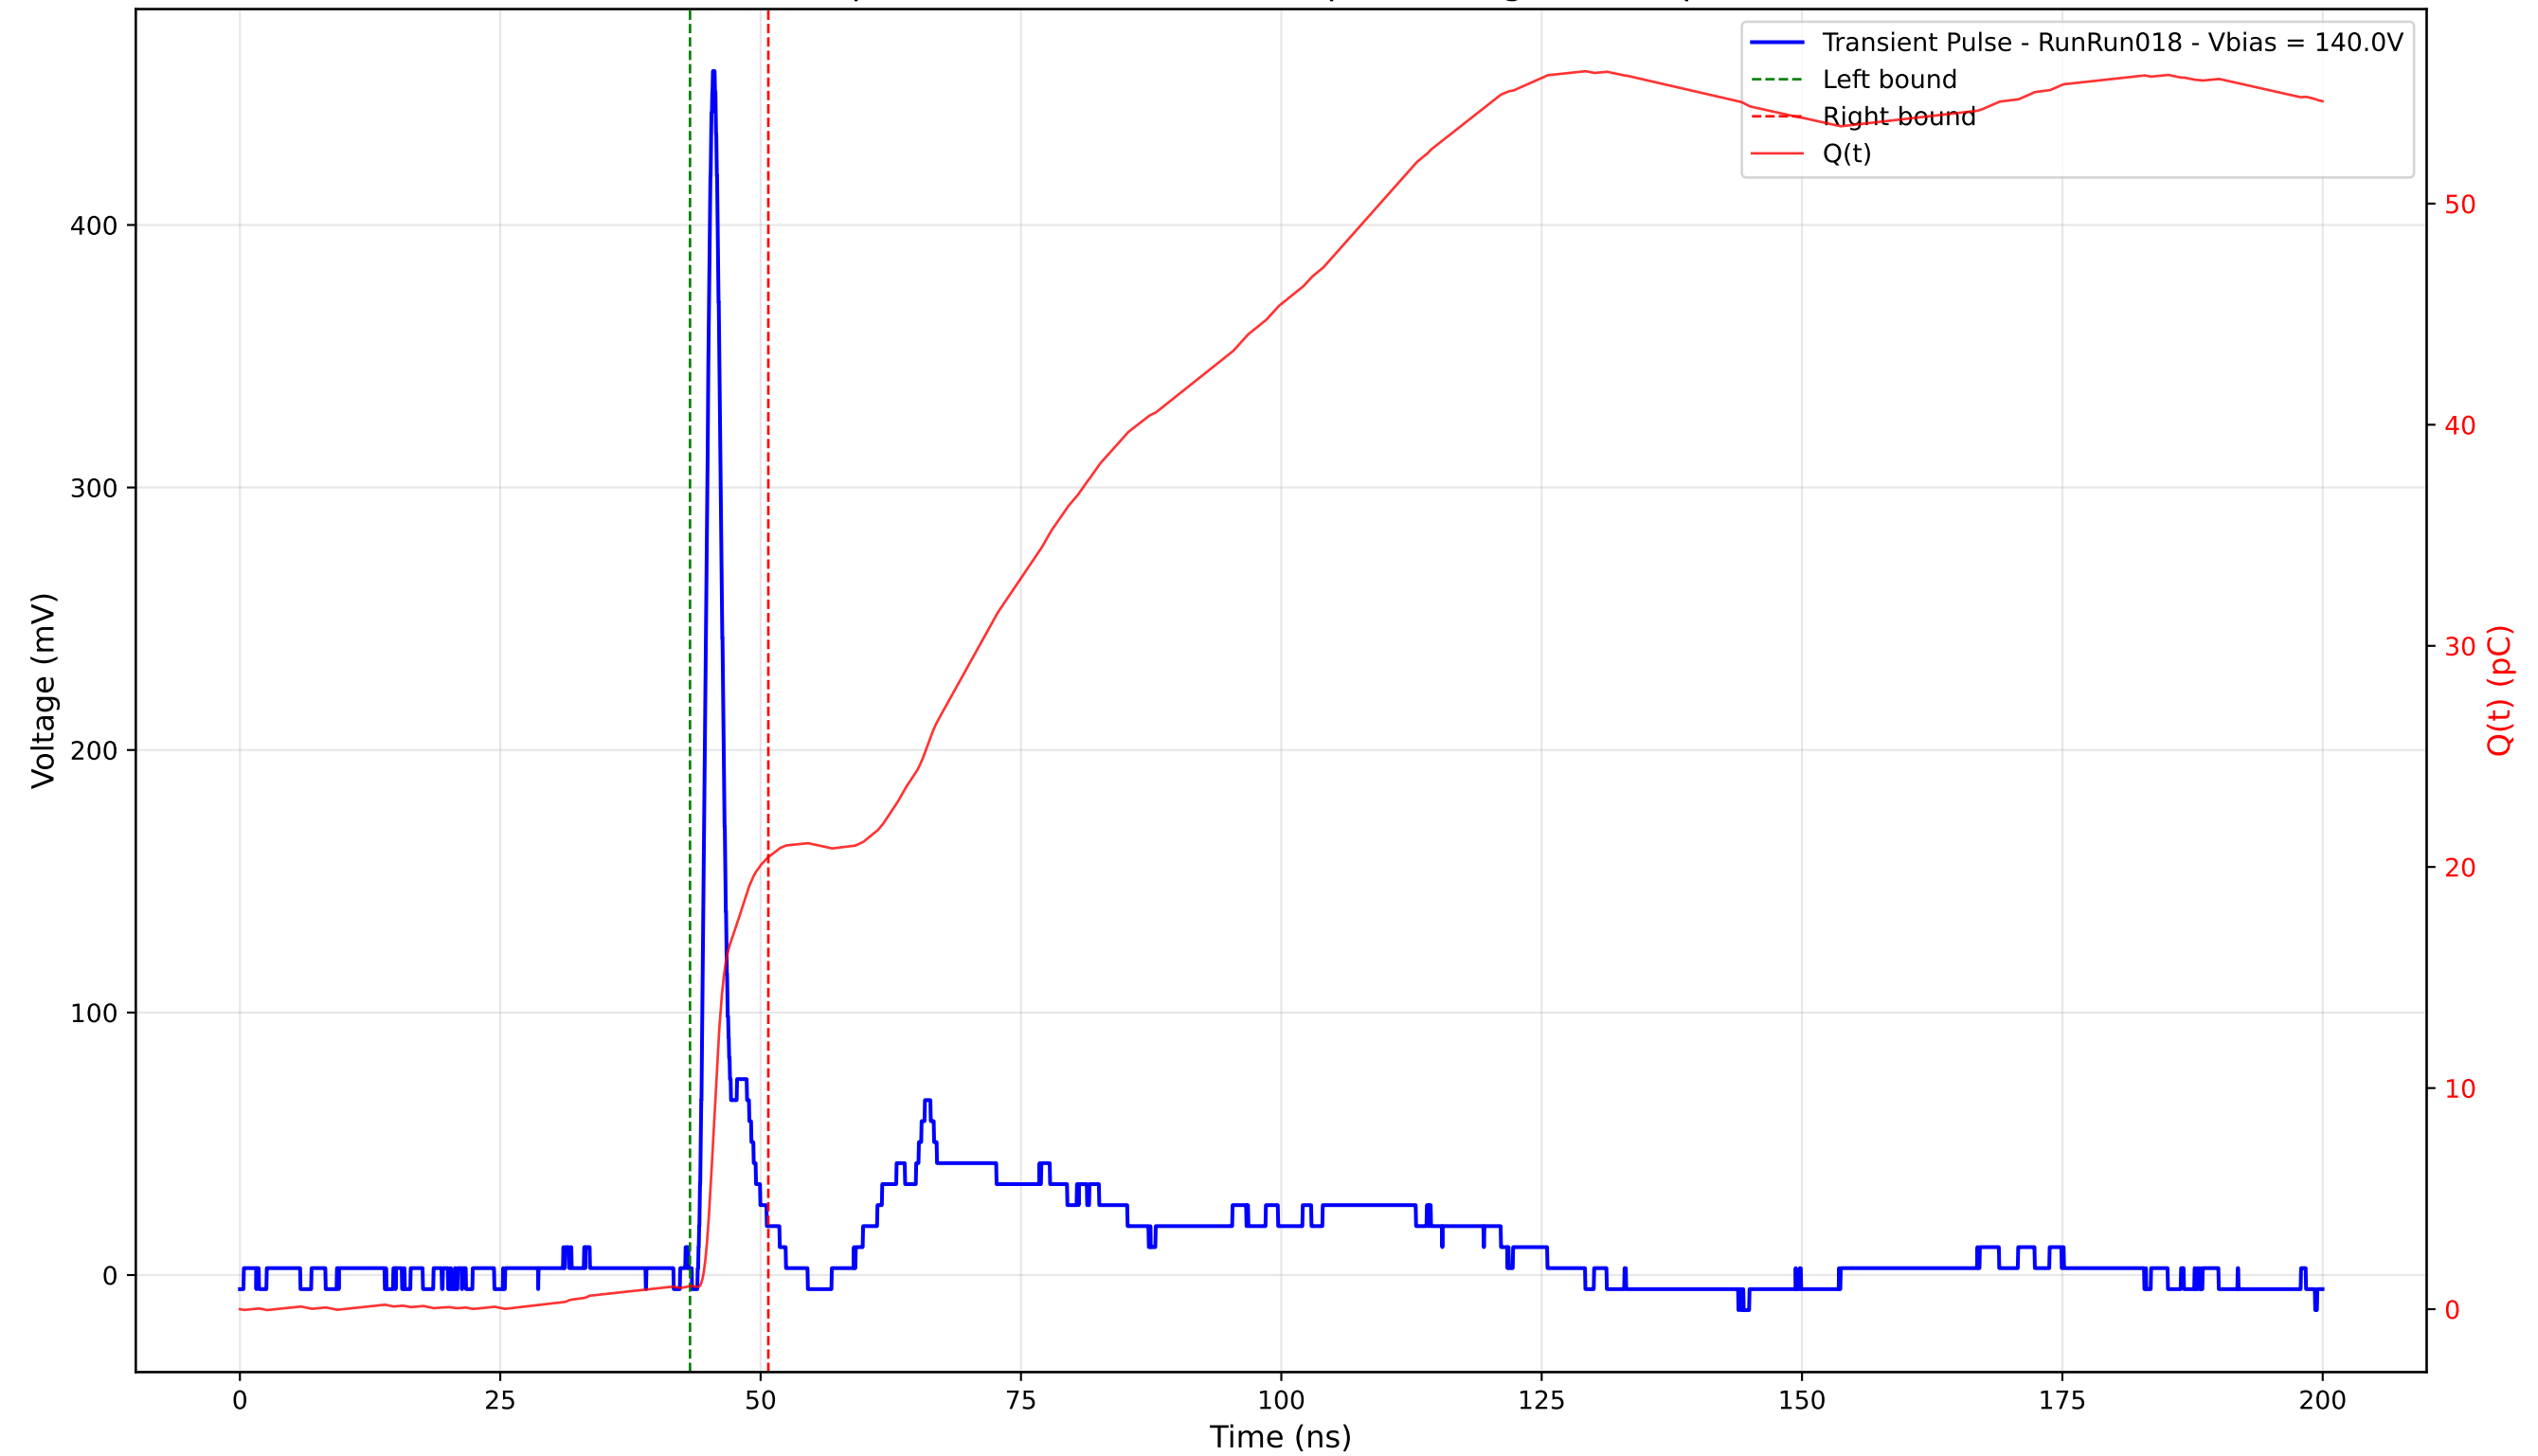


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 19.61 pC - Rise Time: 0.96 ns

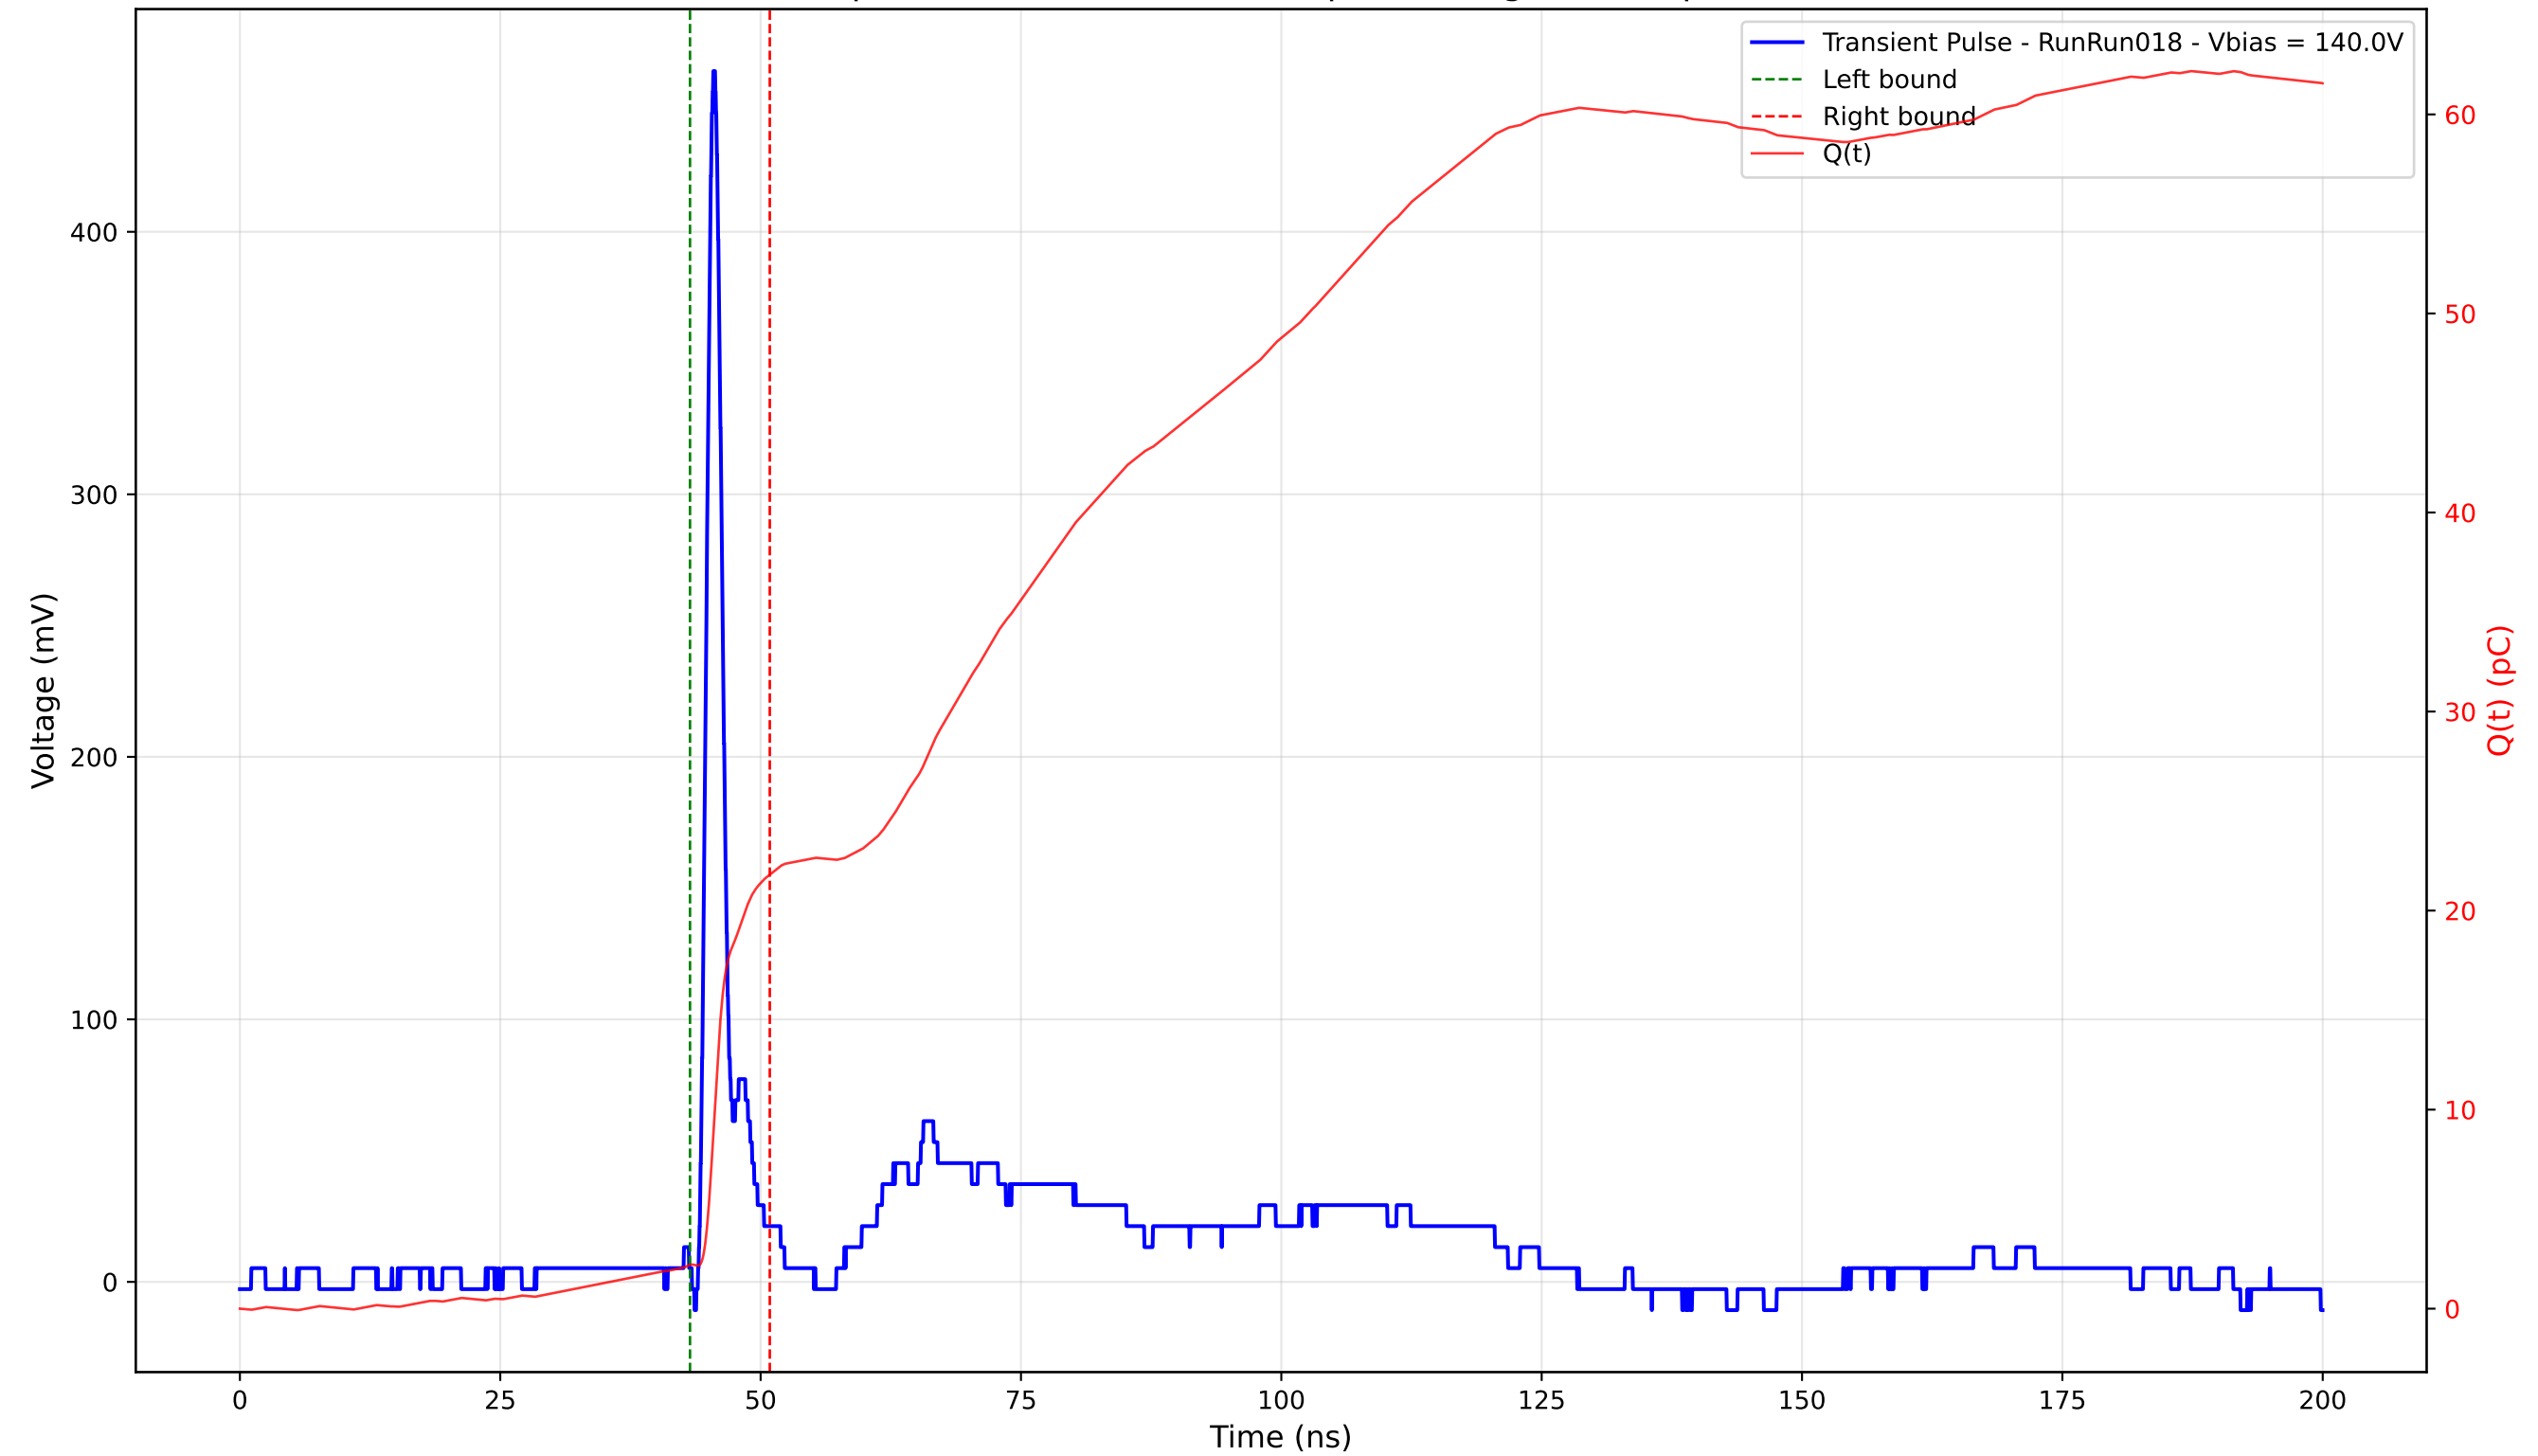


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 19.40 pC - Rise Time: 0.97 ns

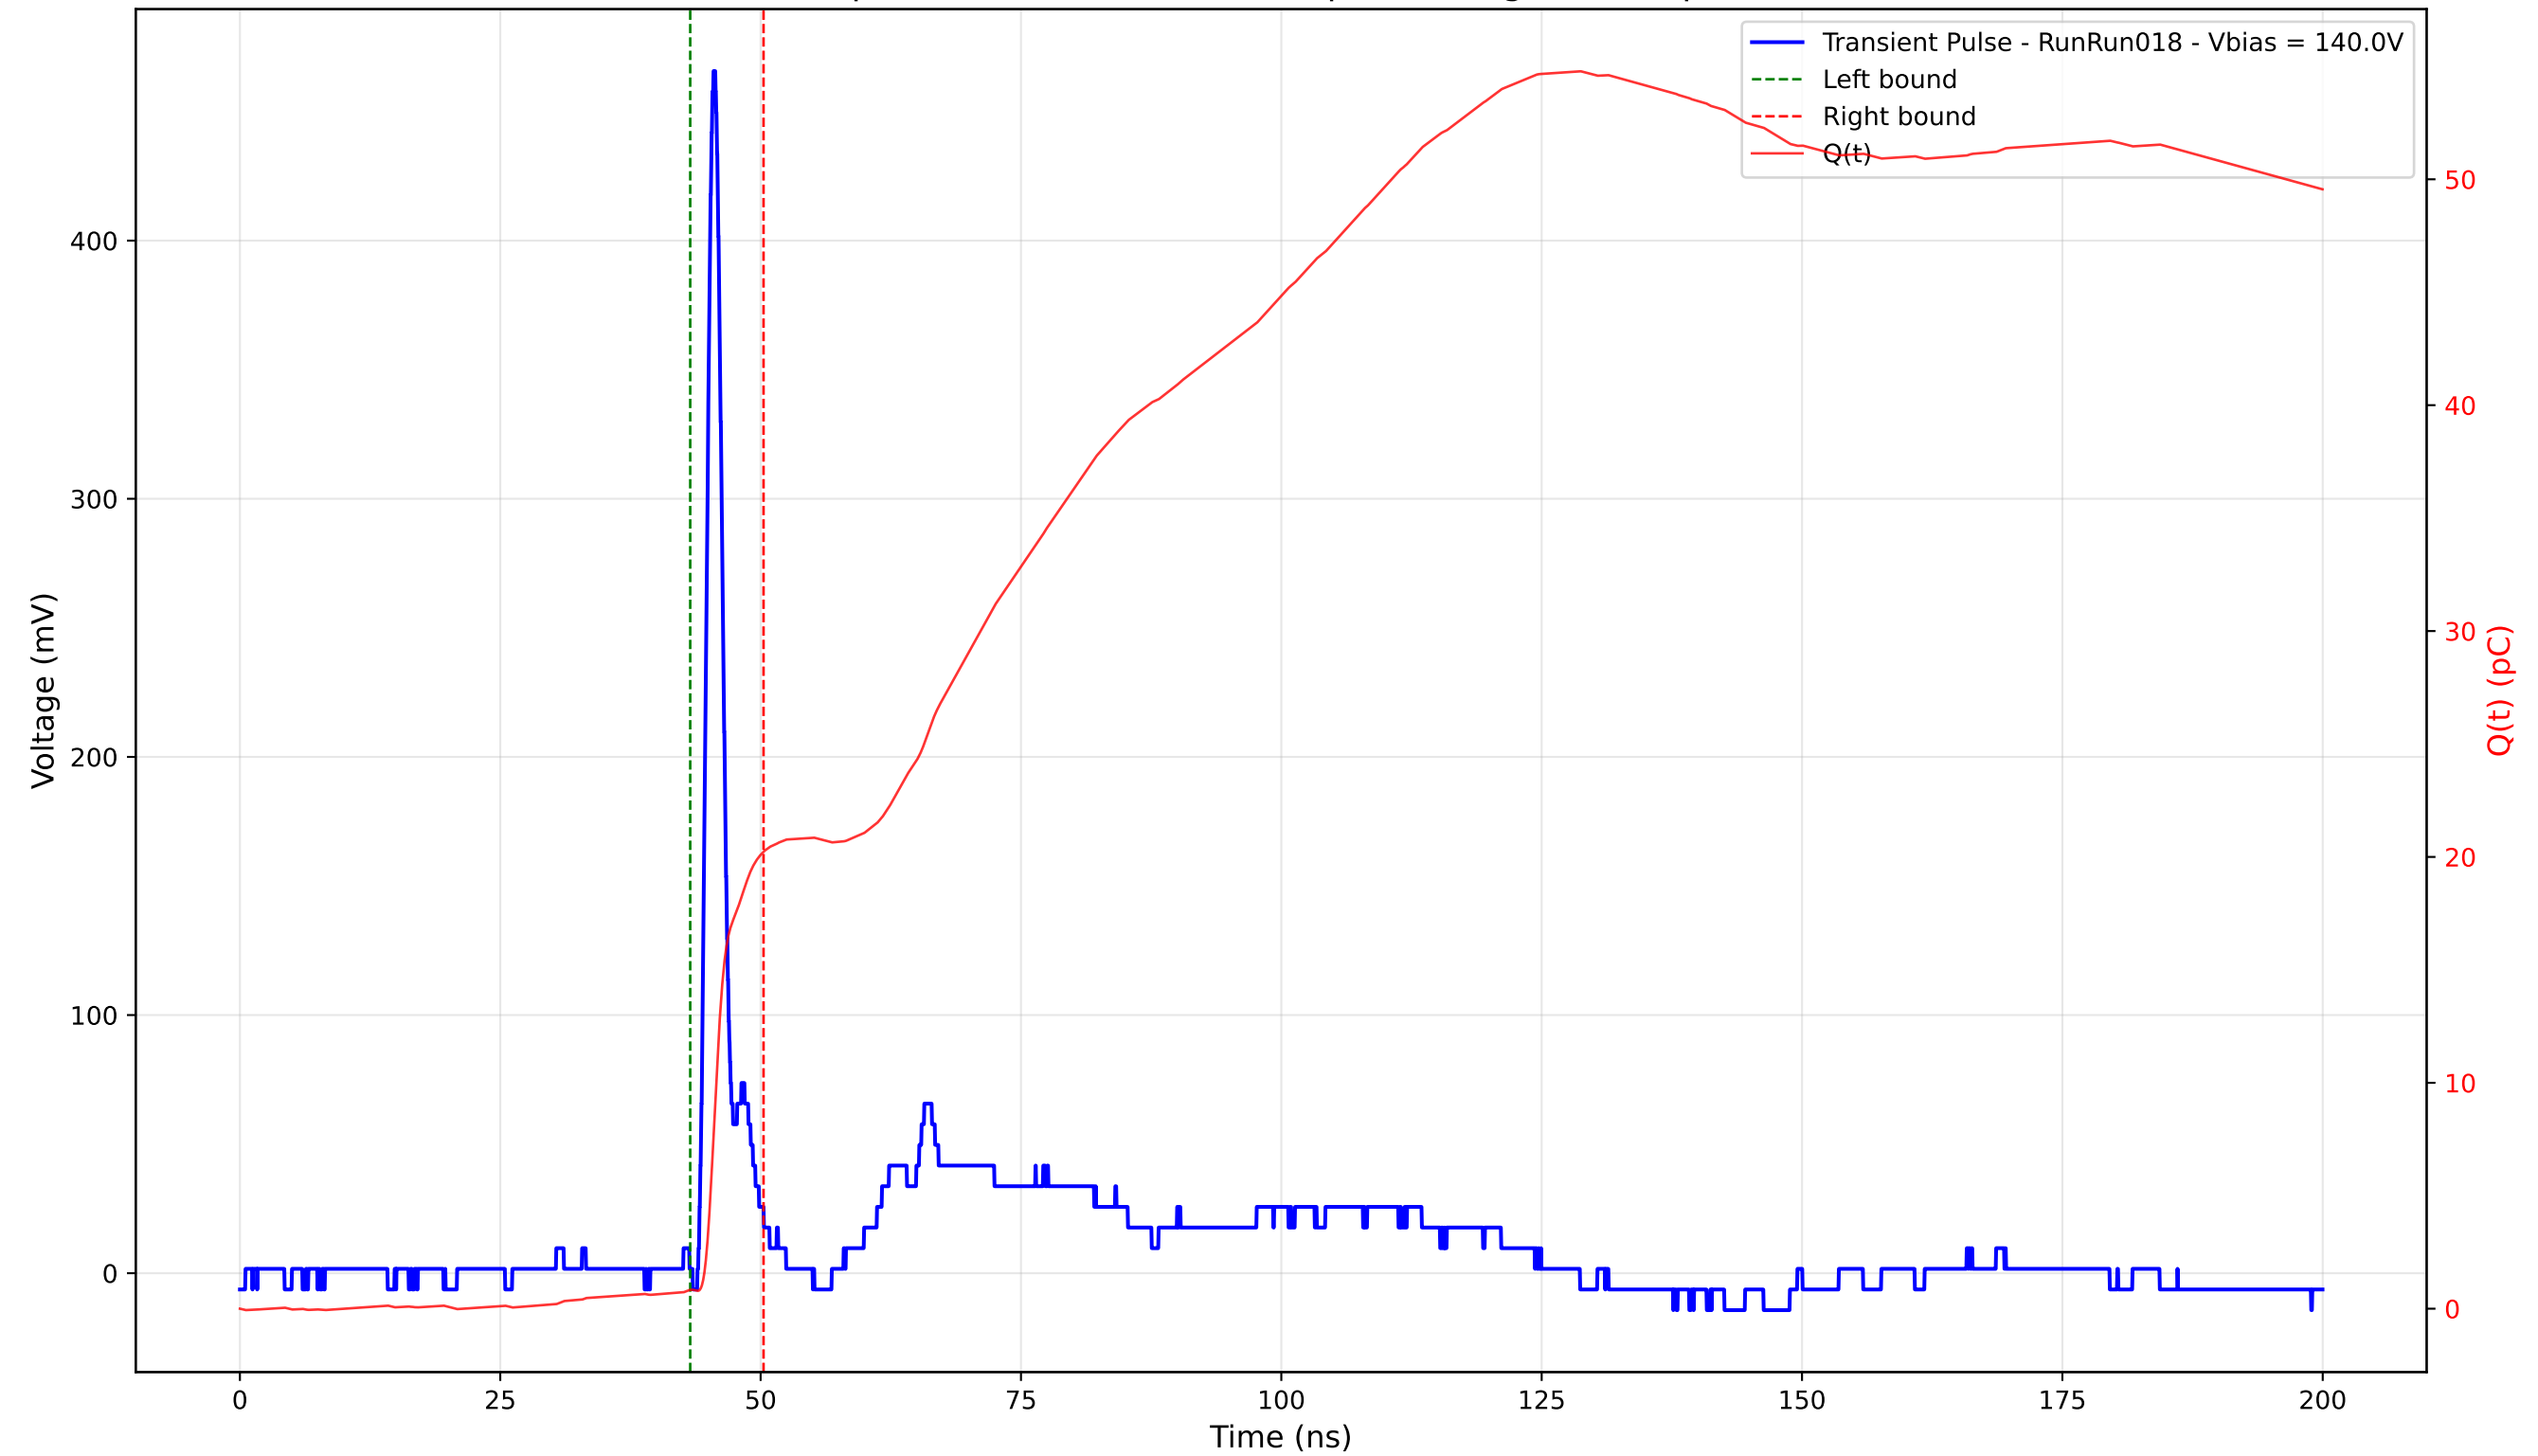


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 19.18 pC - Rise Time: 0.97 ns

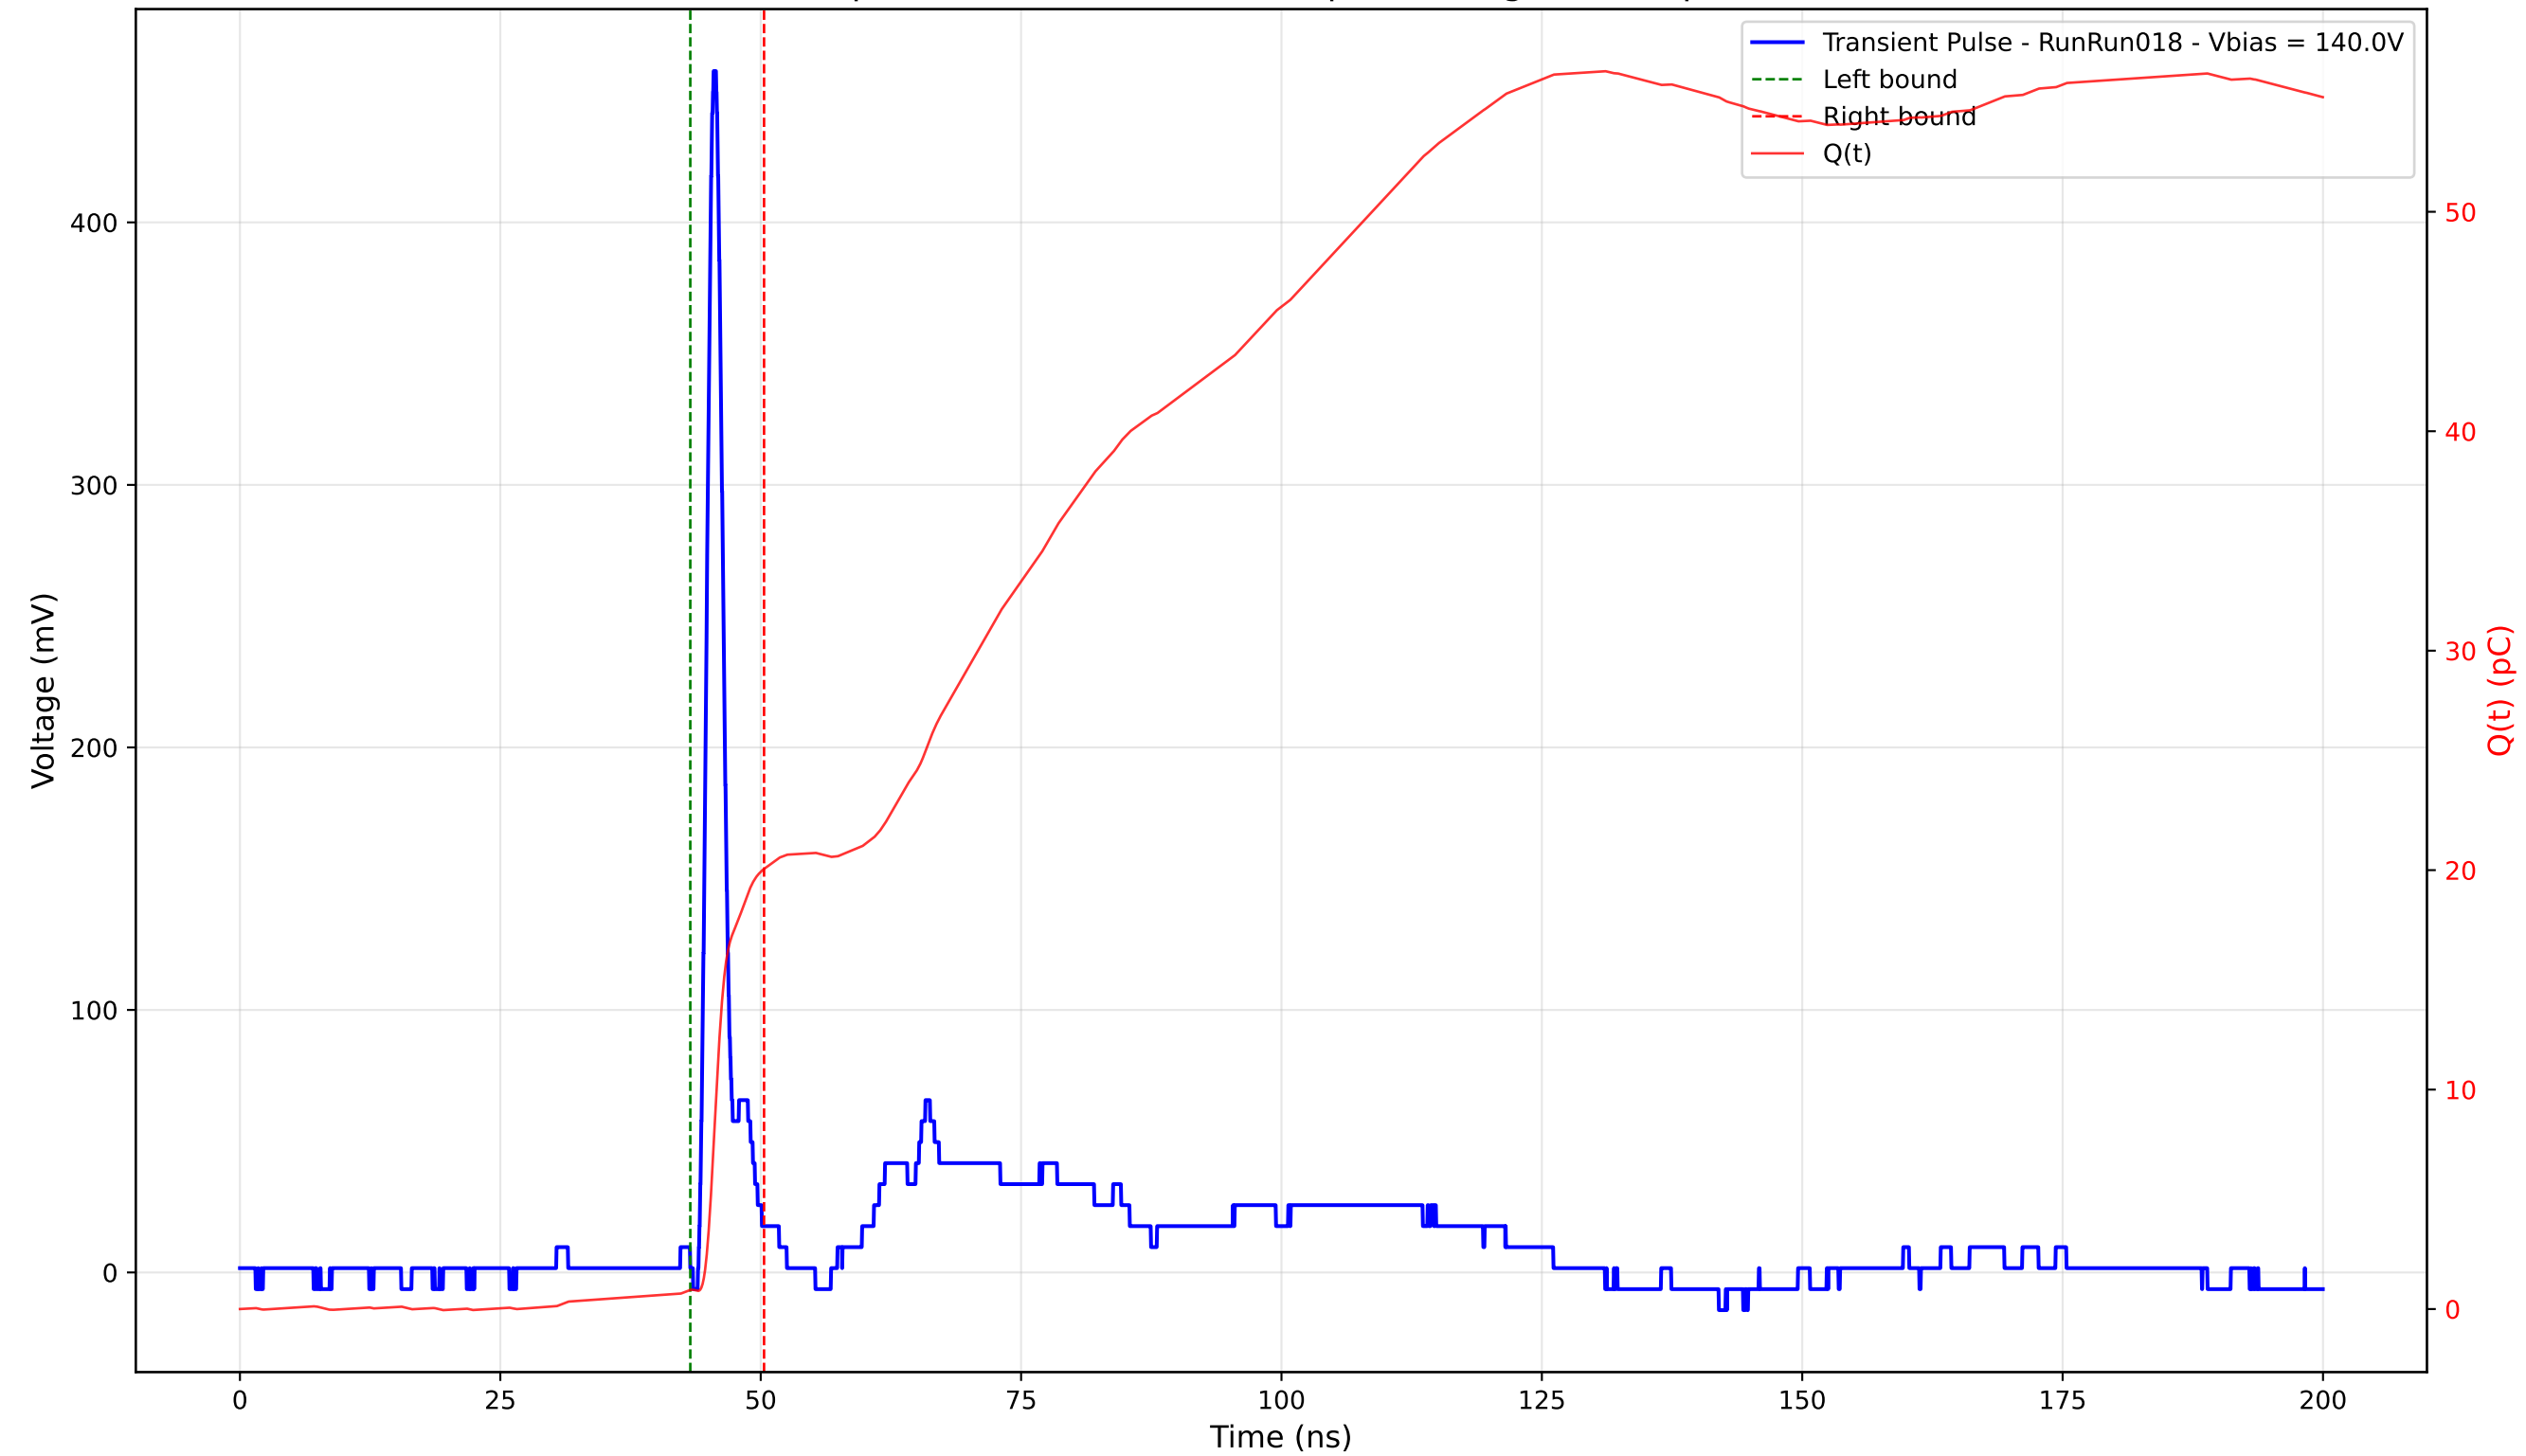


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 19.20 pC - Rise Time: 1.02 ns

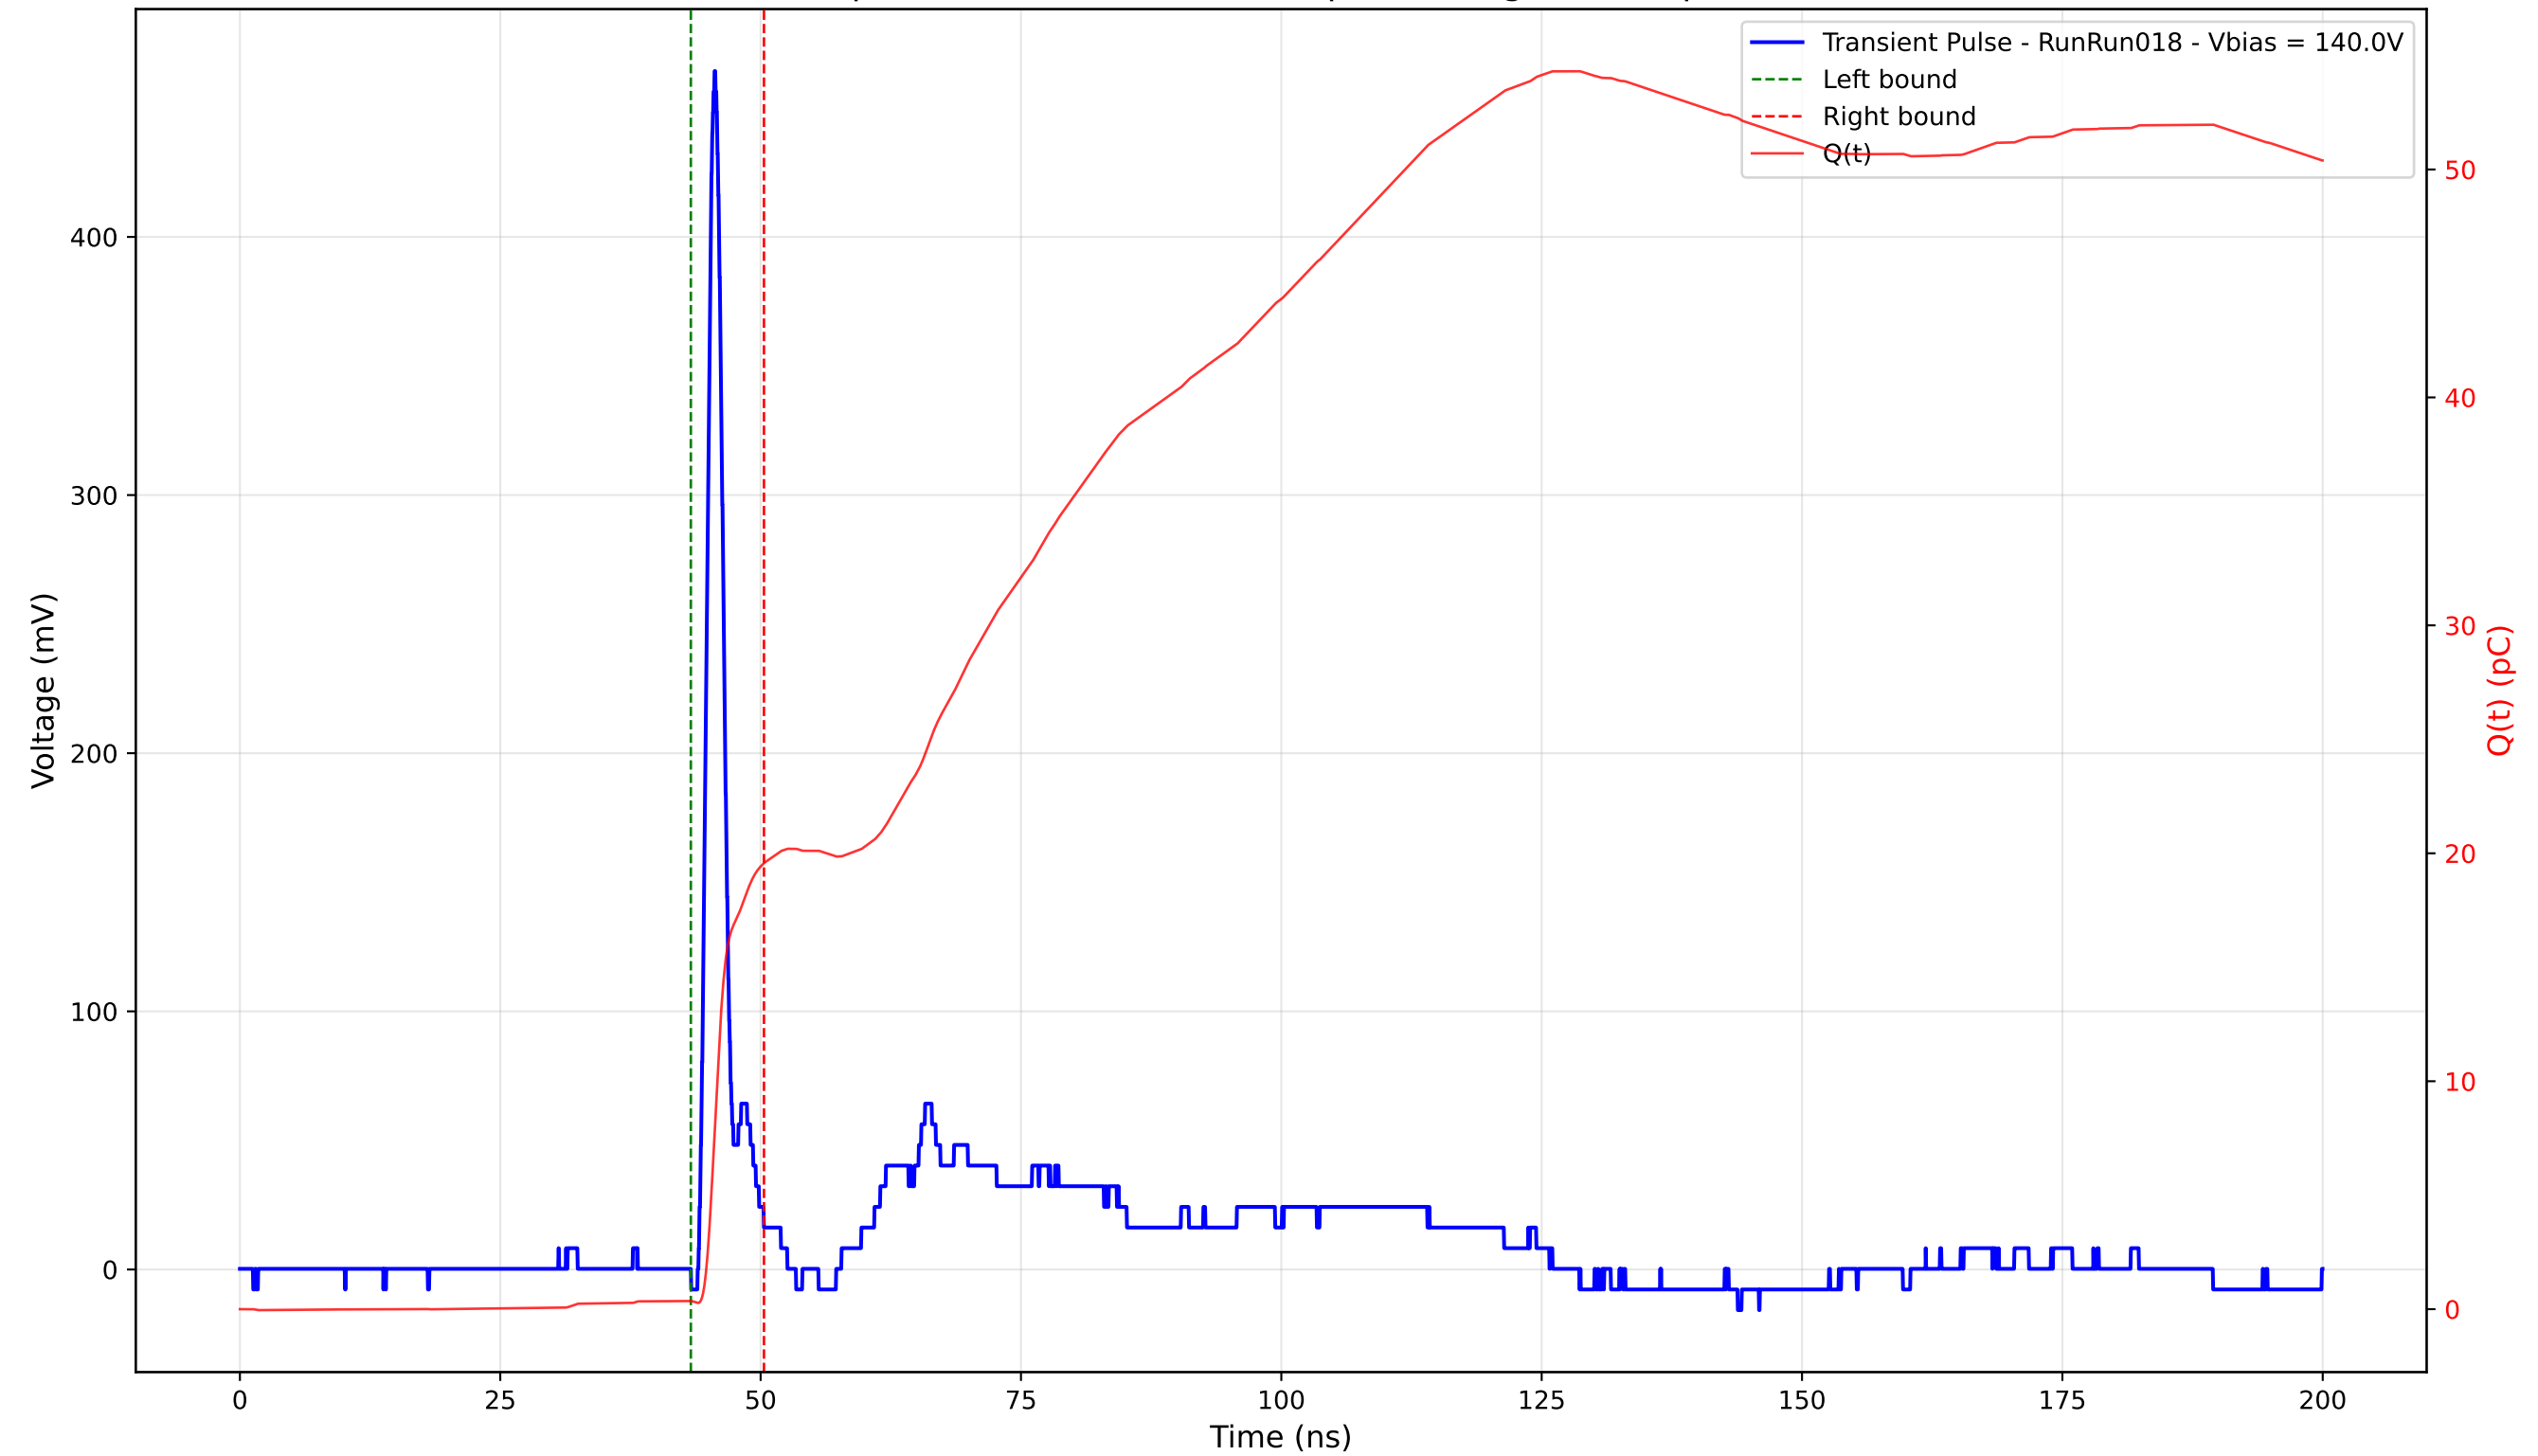


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 19.64 pC - Rise Time: 1.03 ns

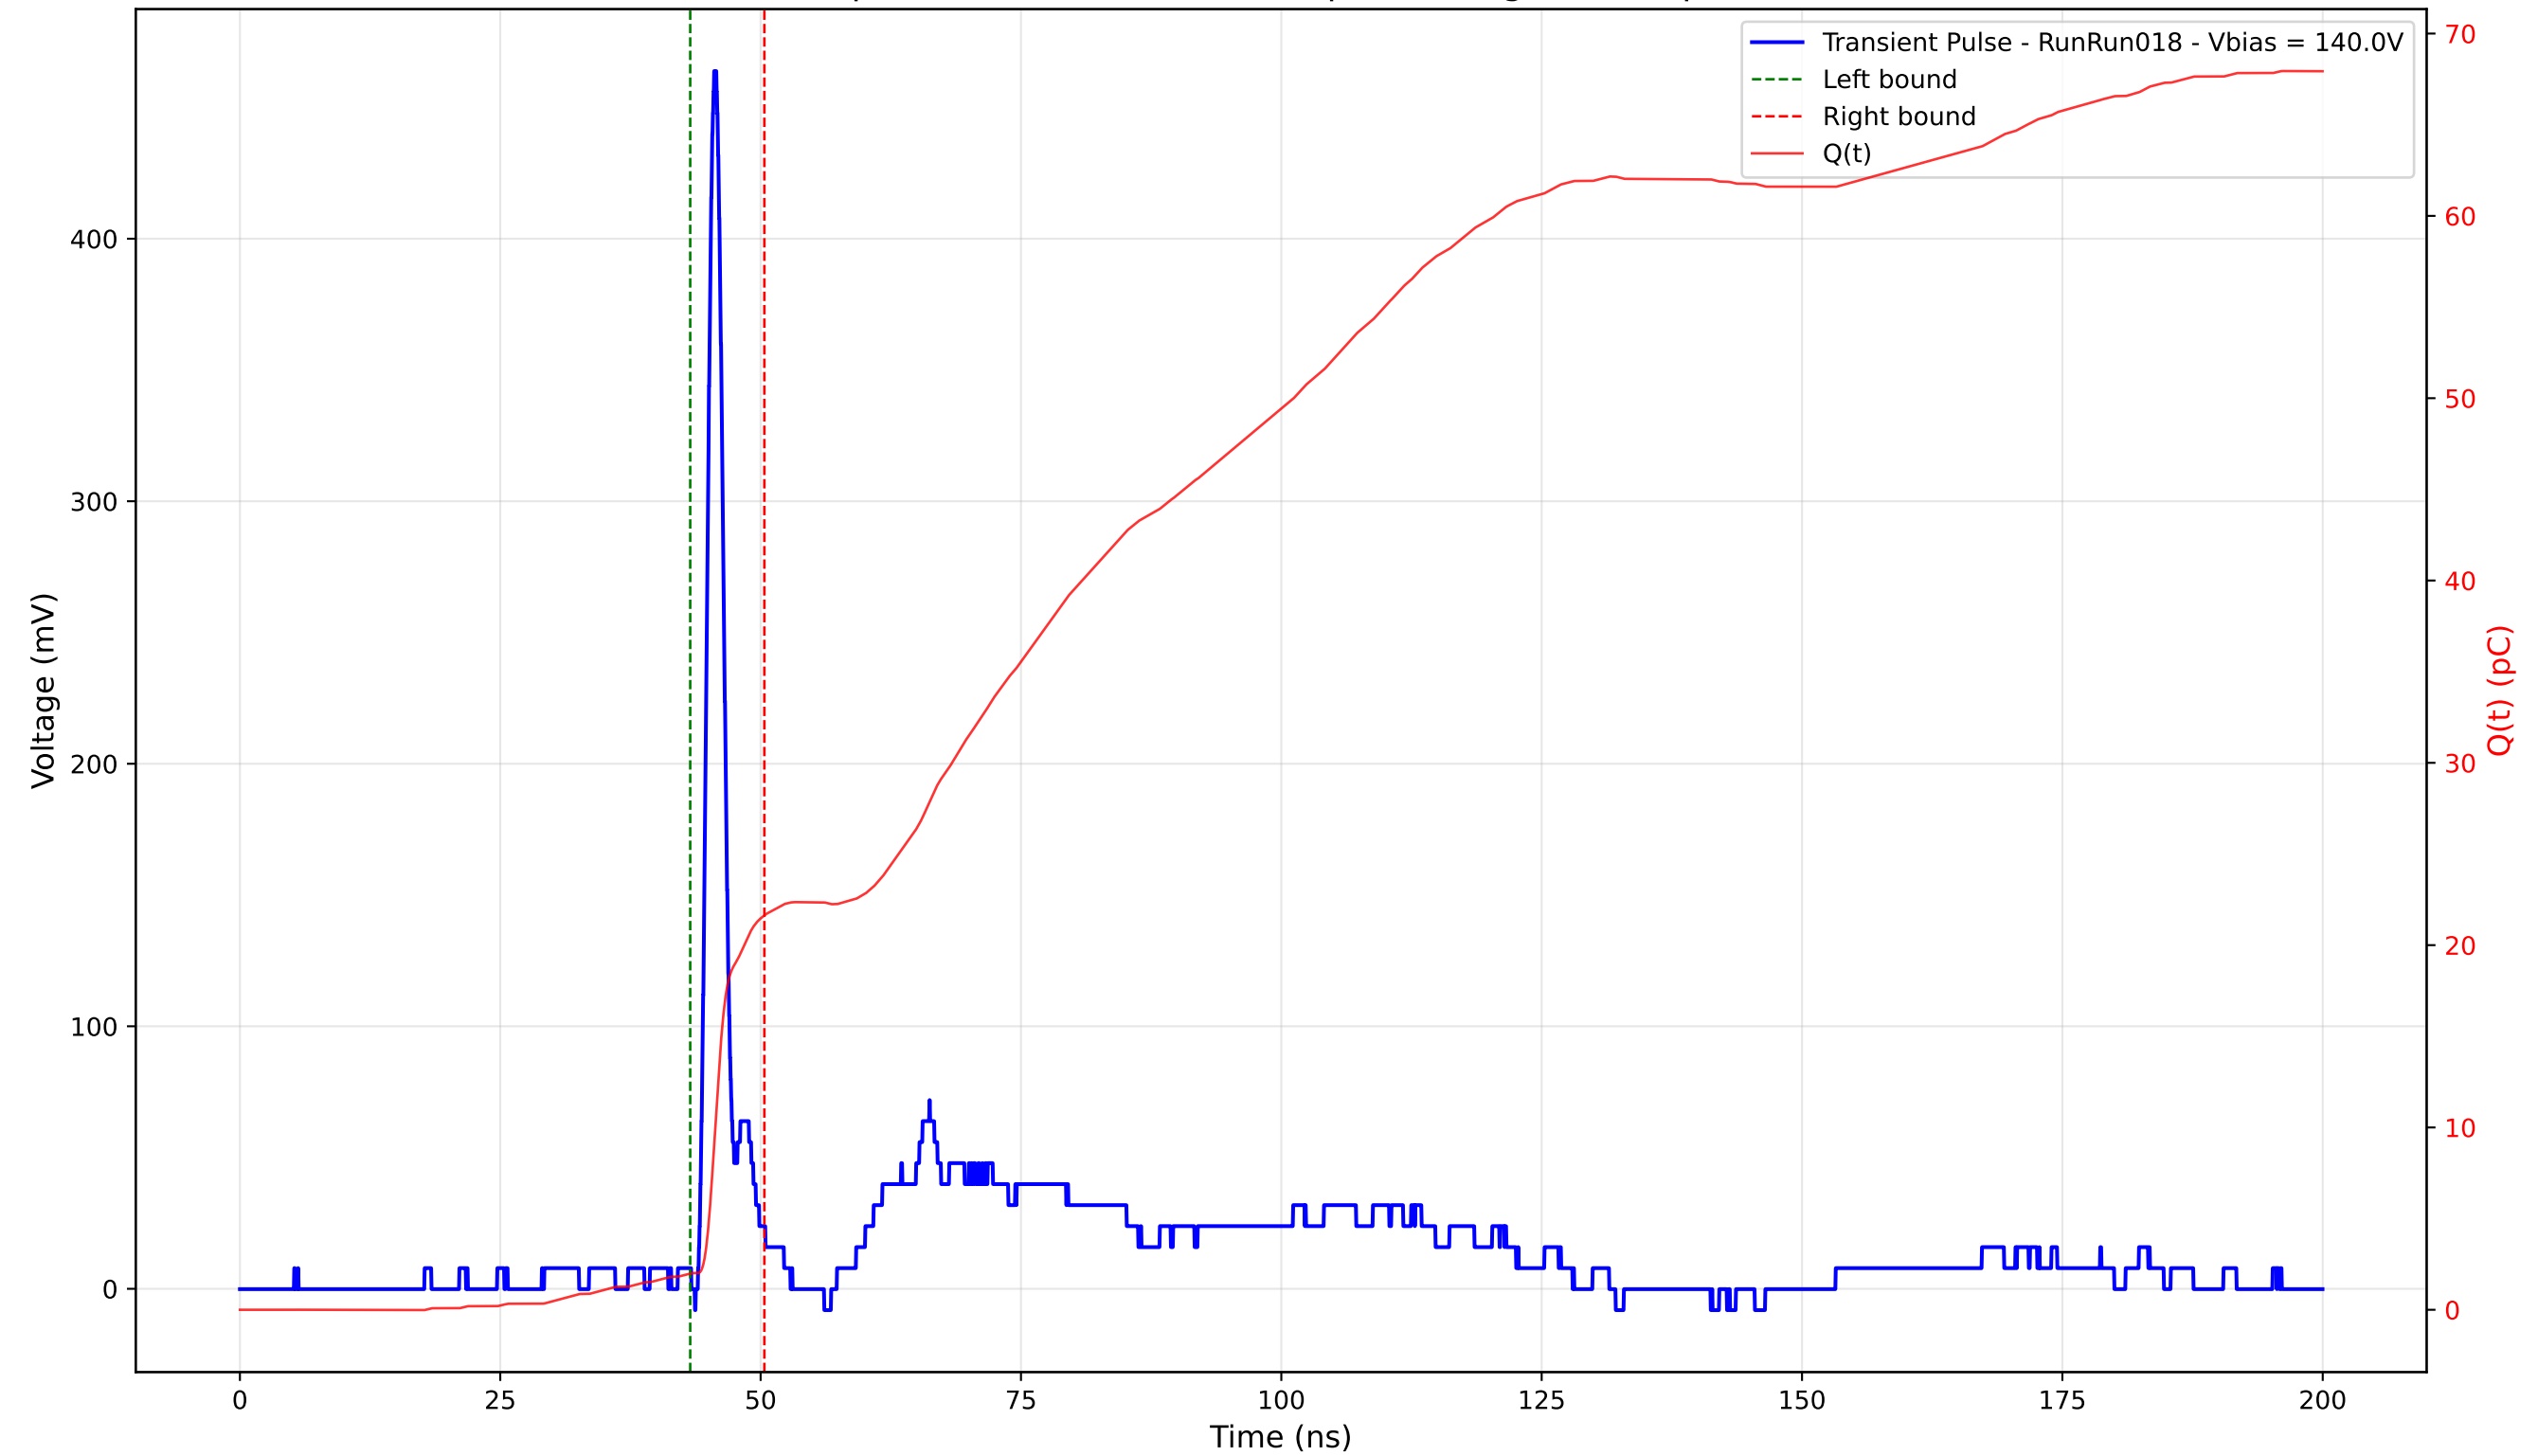


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 19.44 pC - Rise Time: 1.03 ns

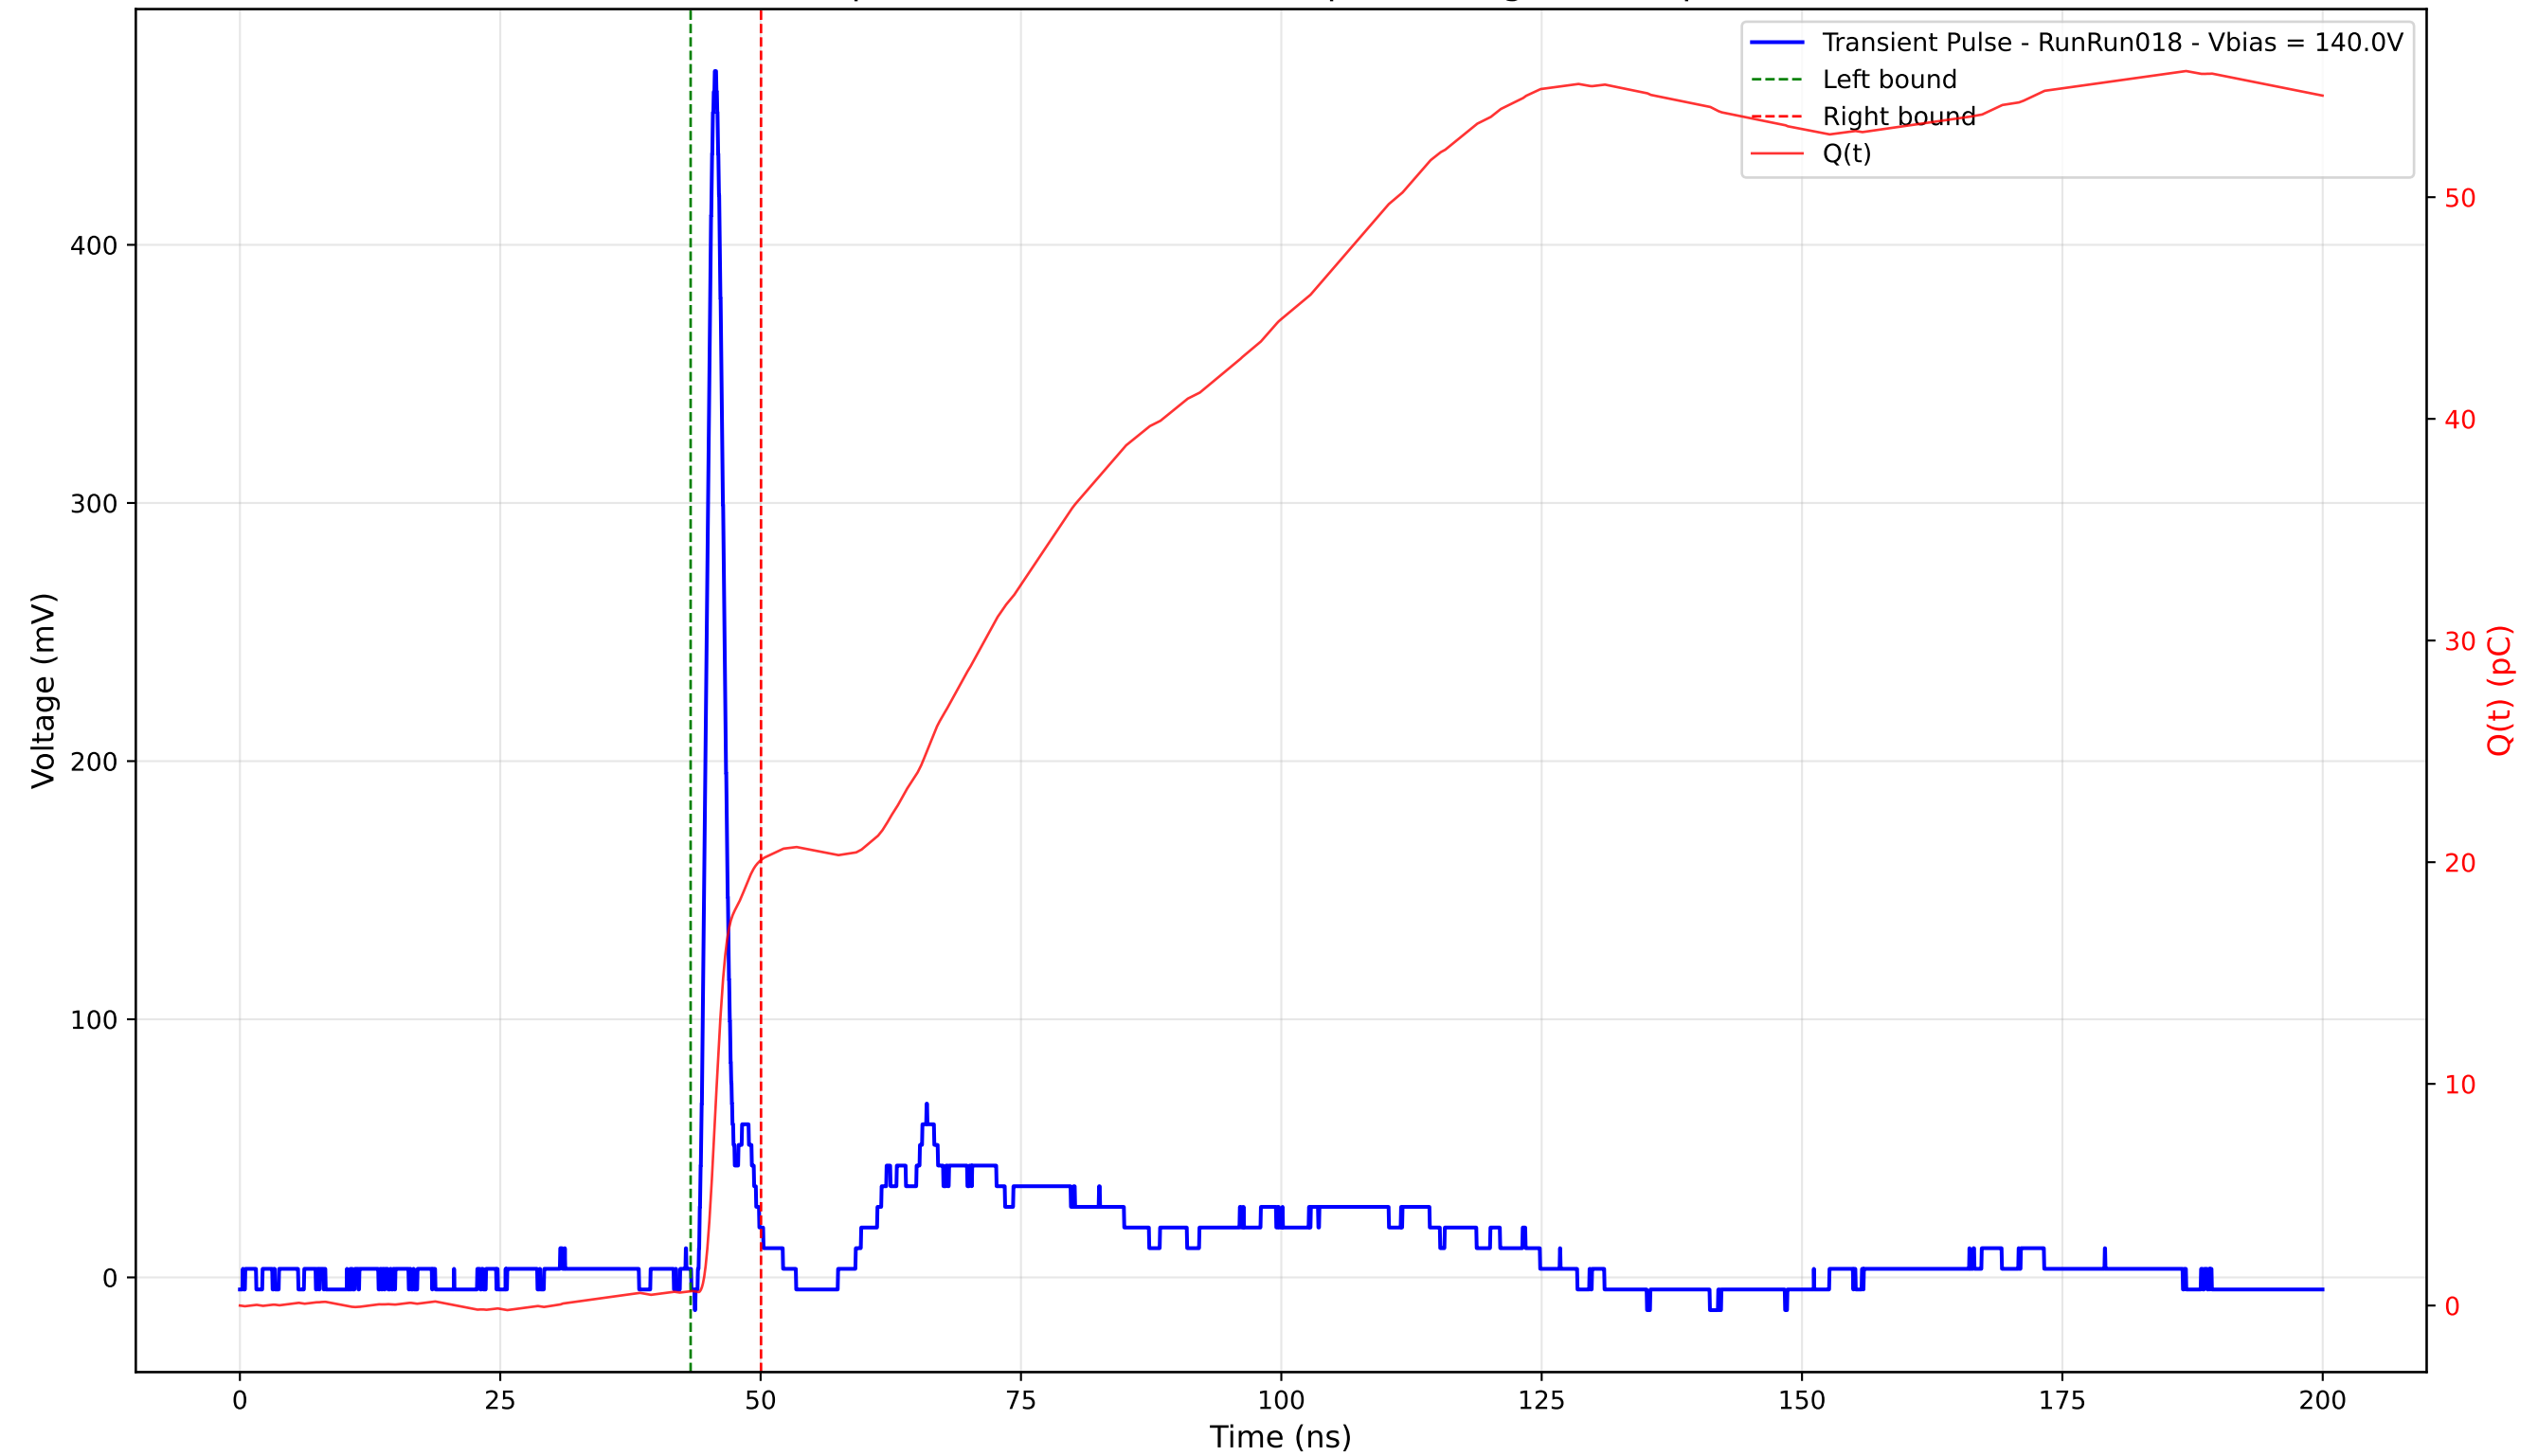


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 19.43 pC - Rise Time: 1.04 ns

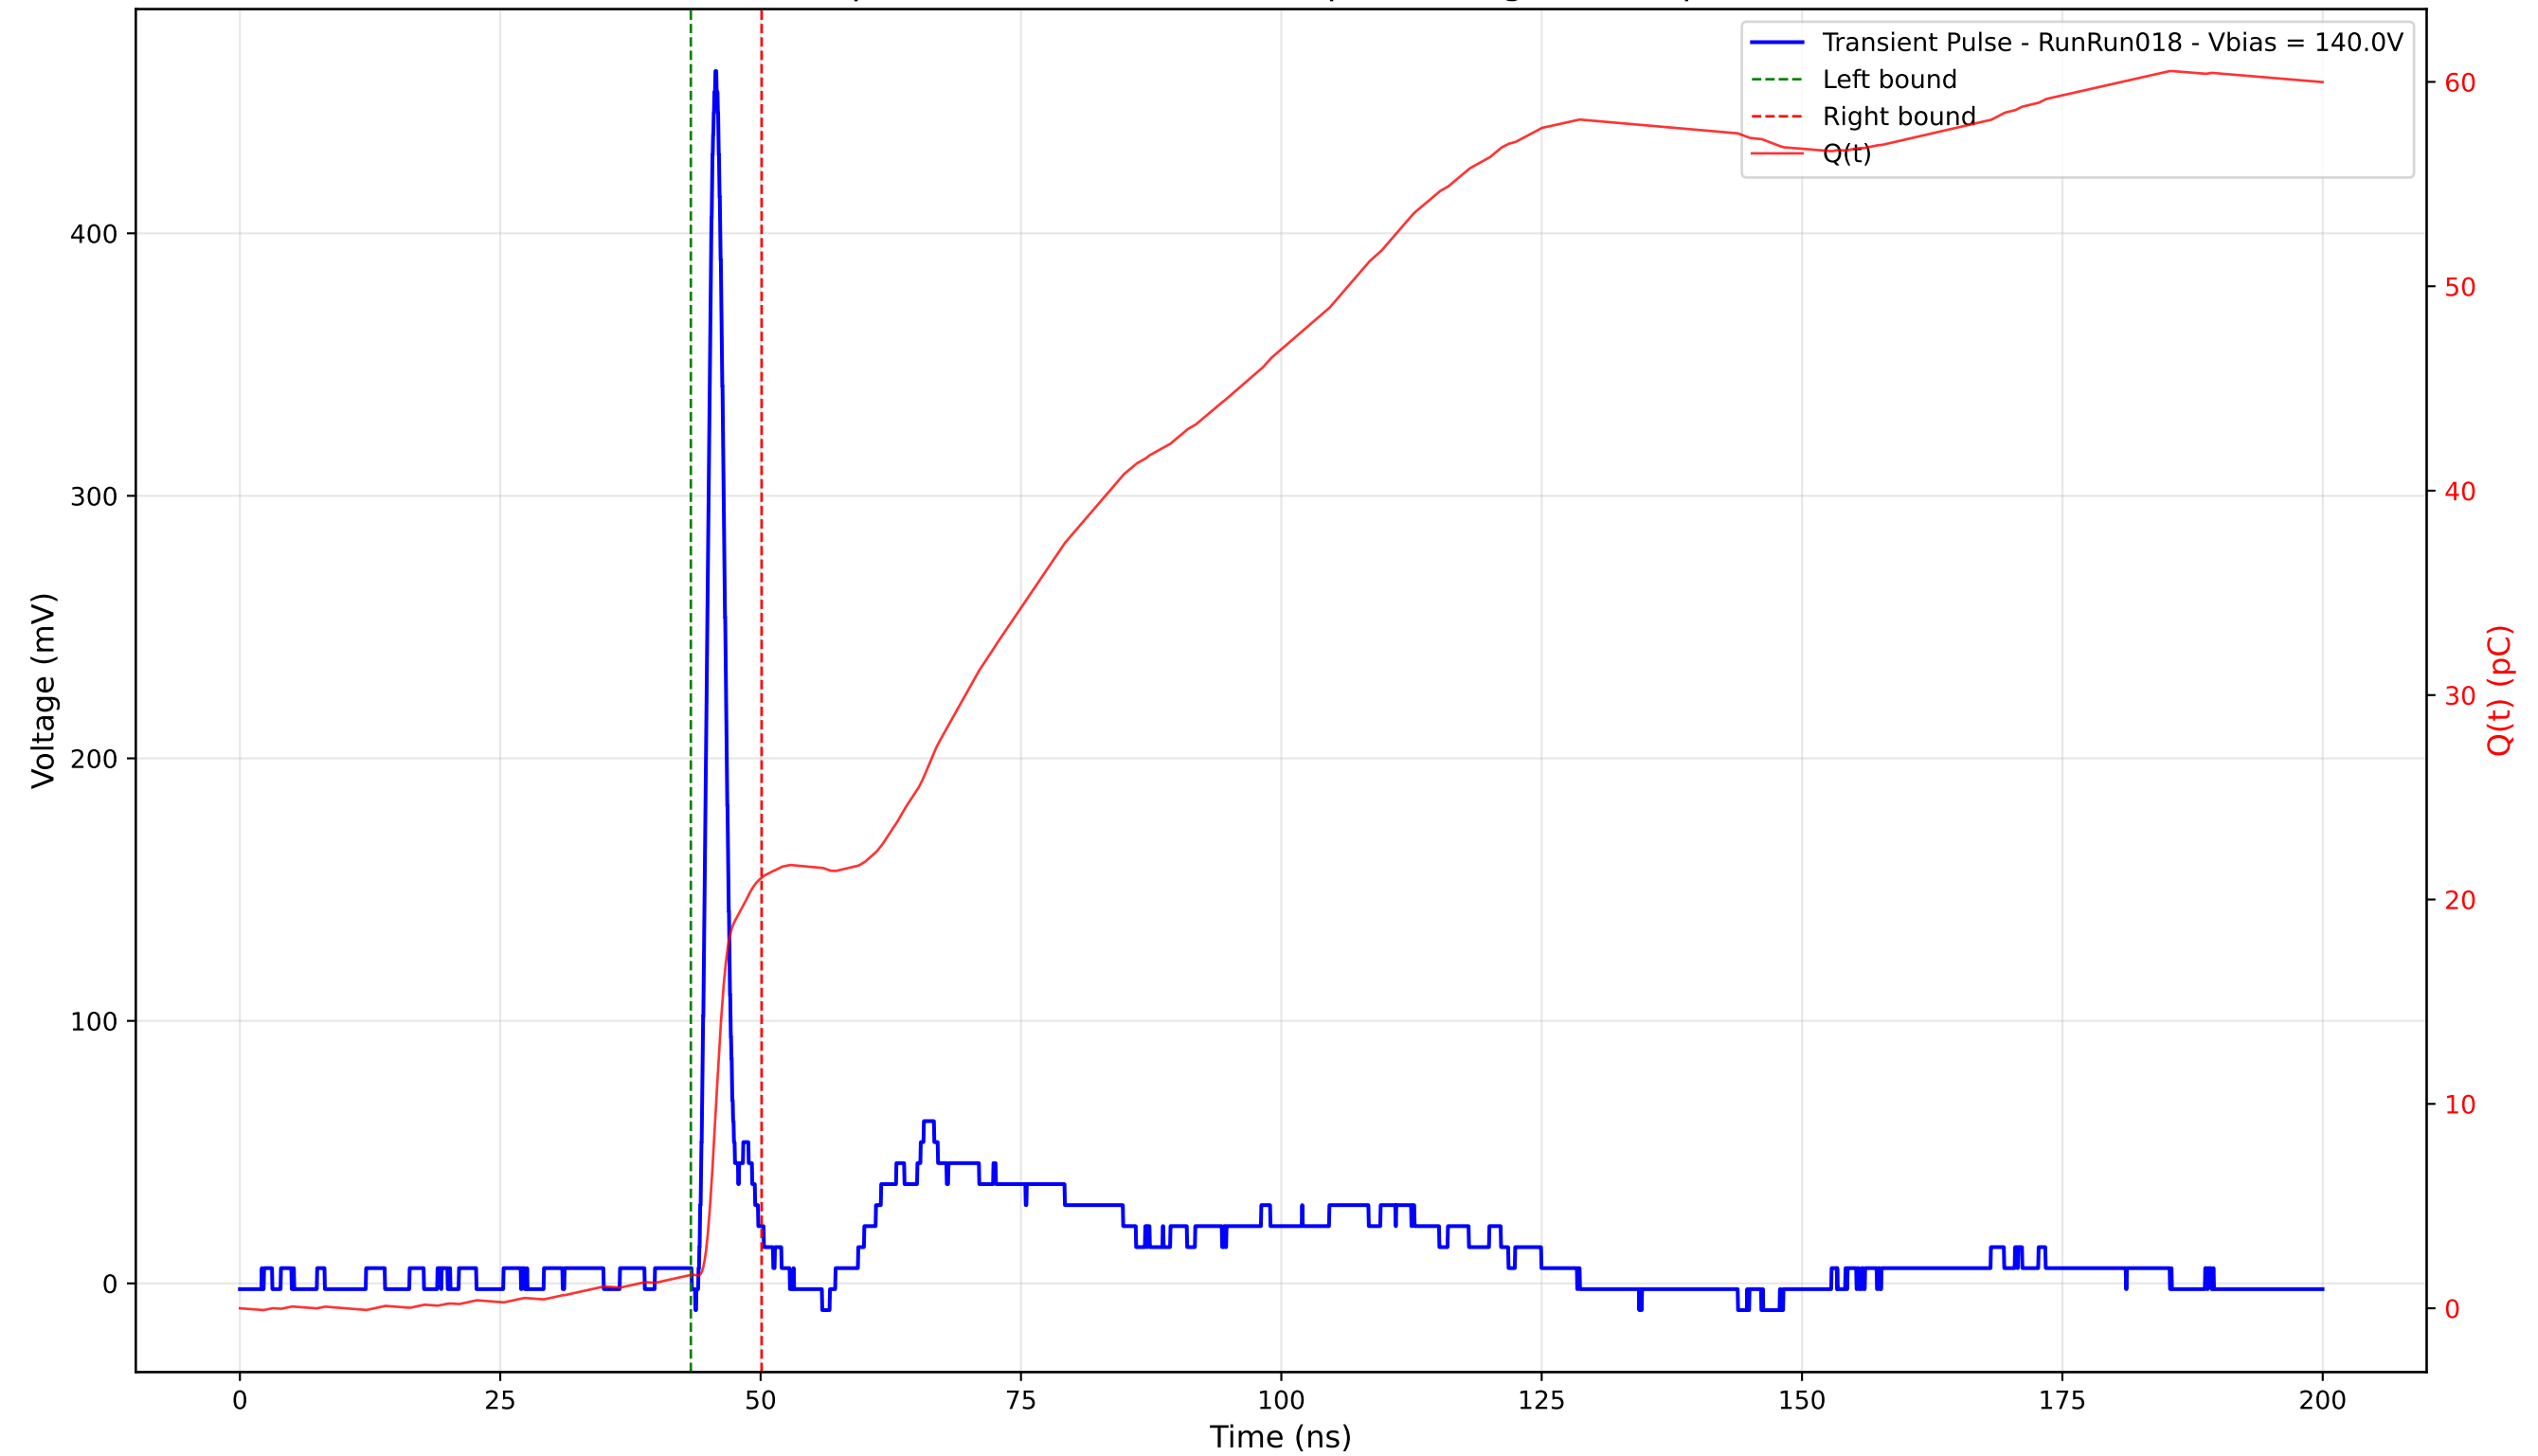


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 19.84 pC - Rise Time: 1.06 ns

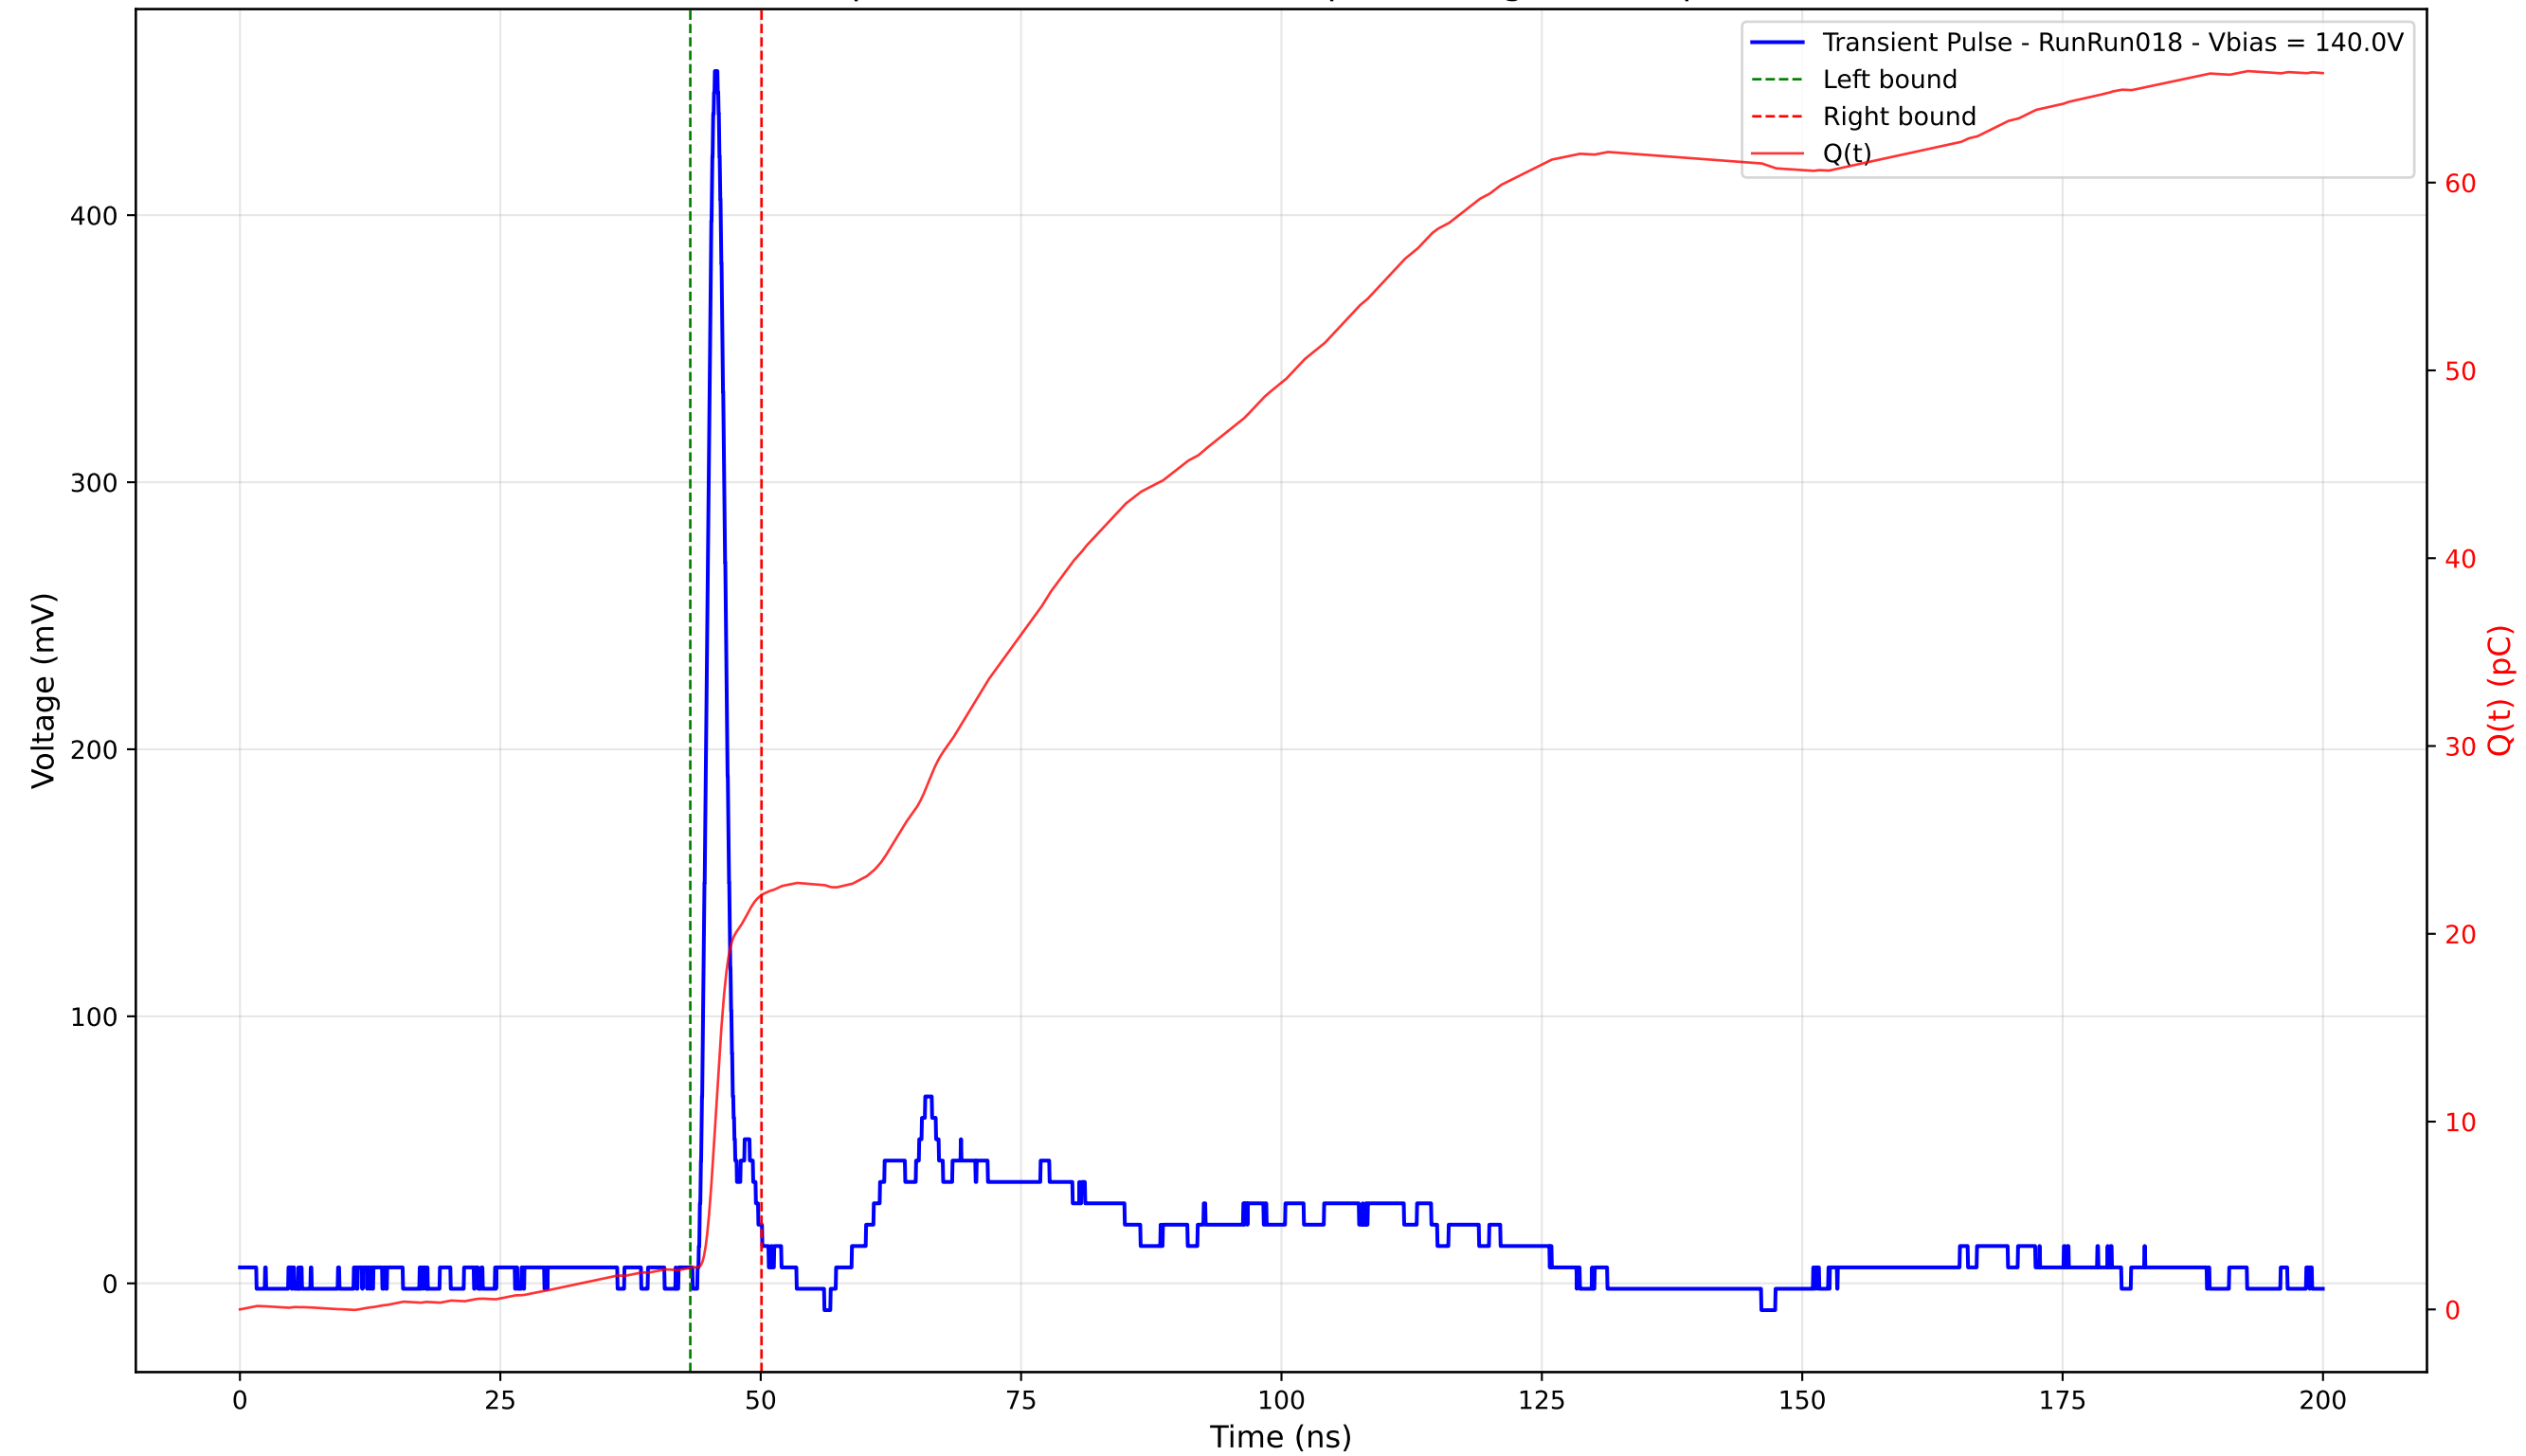


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 19.58 pC - Rise Time: 1.08 ns

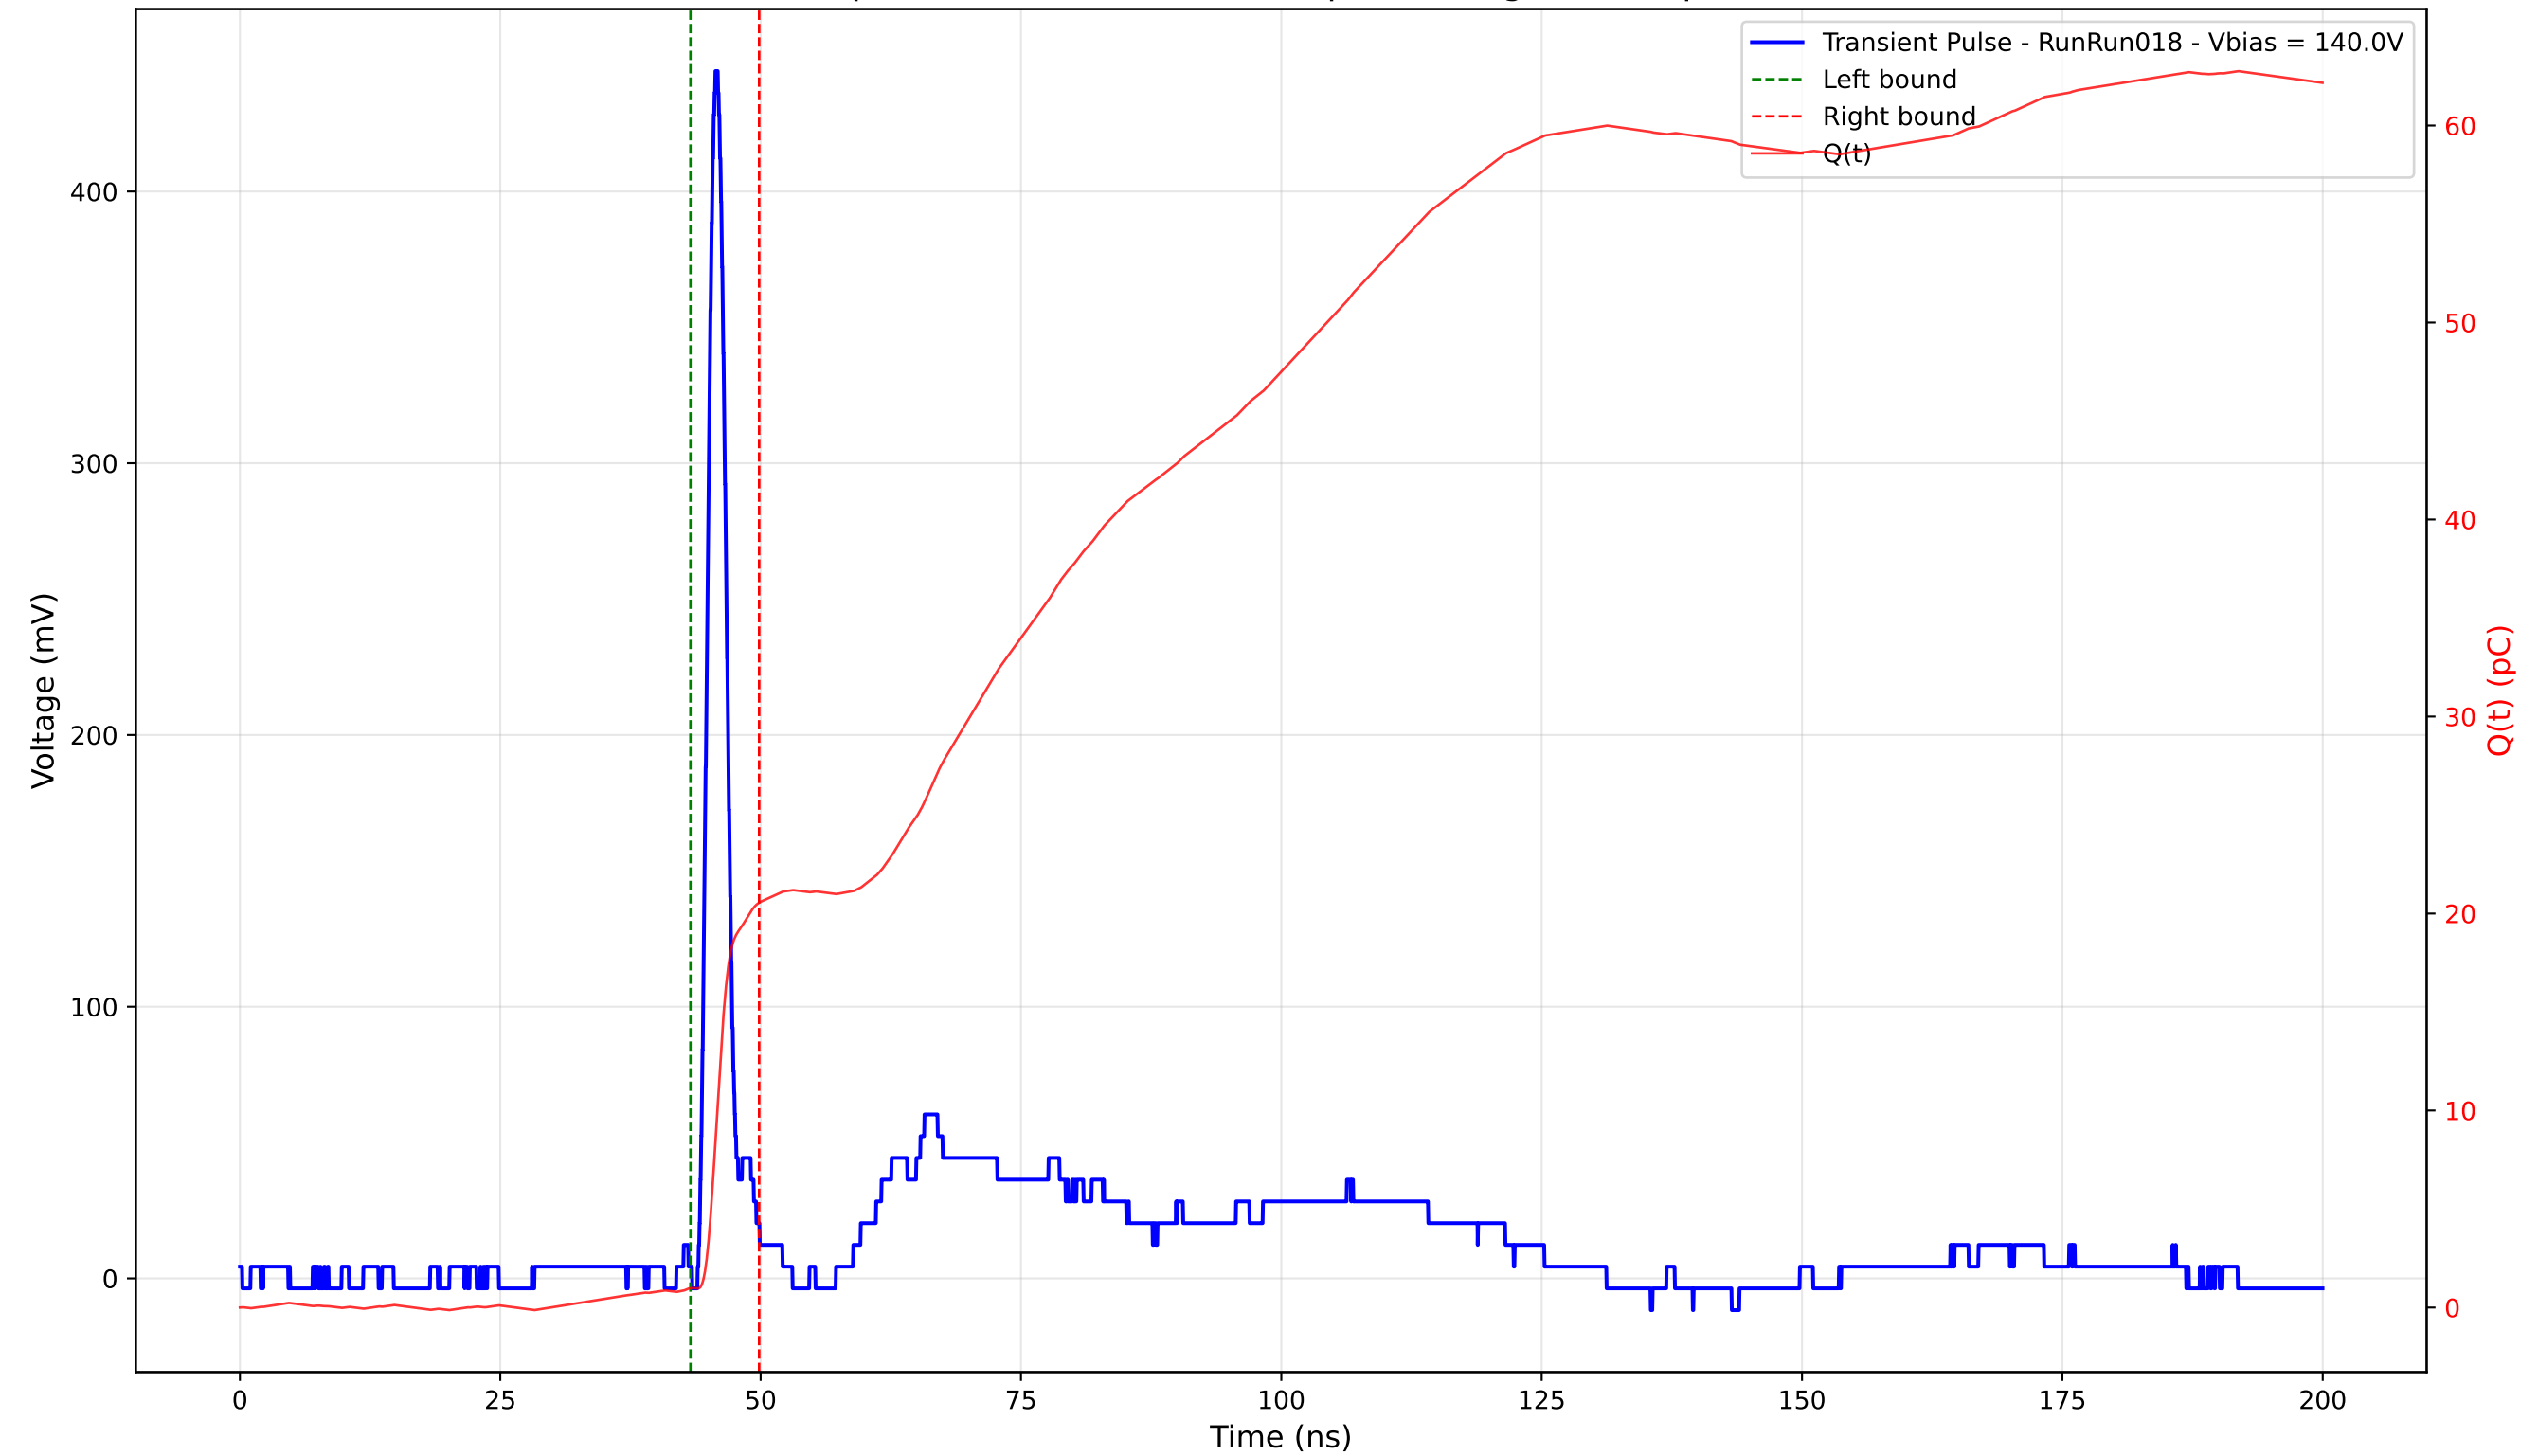


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 19.35 pC - Rise Time: 1.10 ns

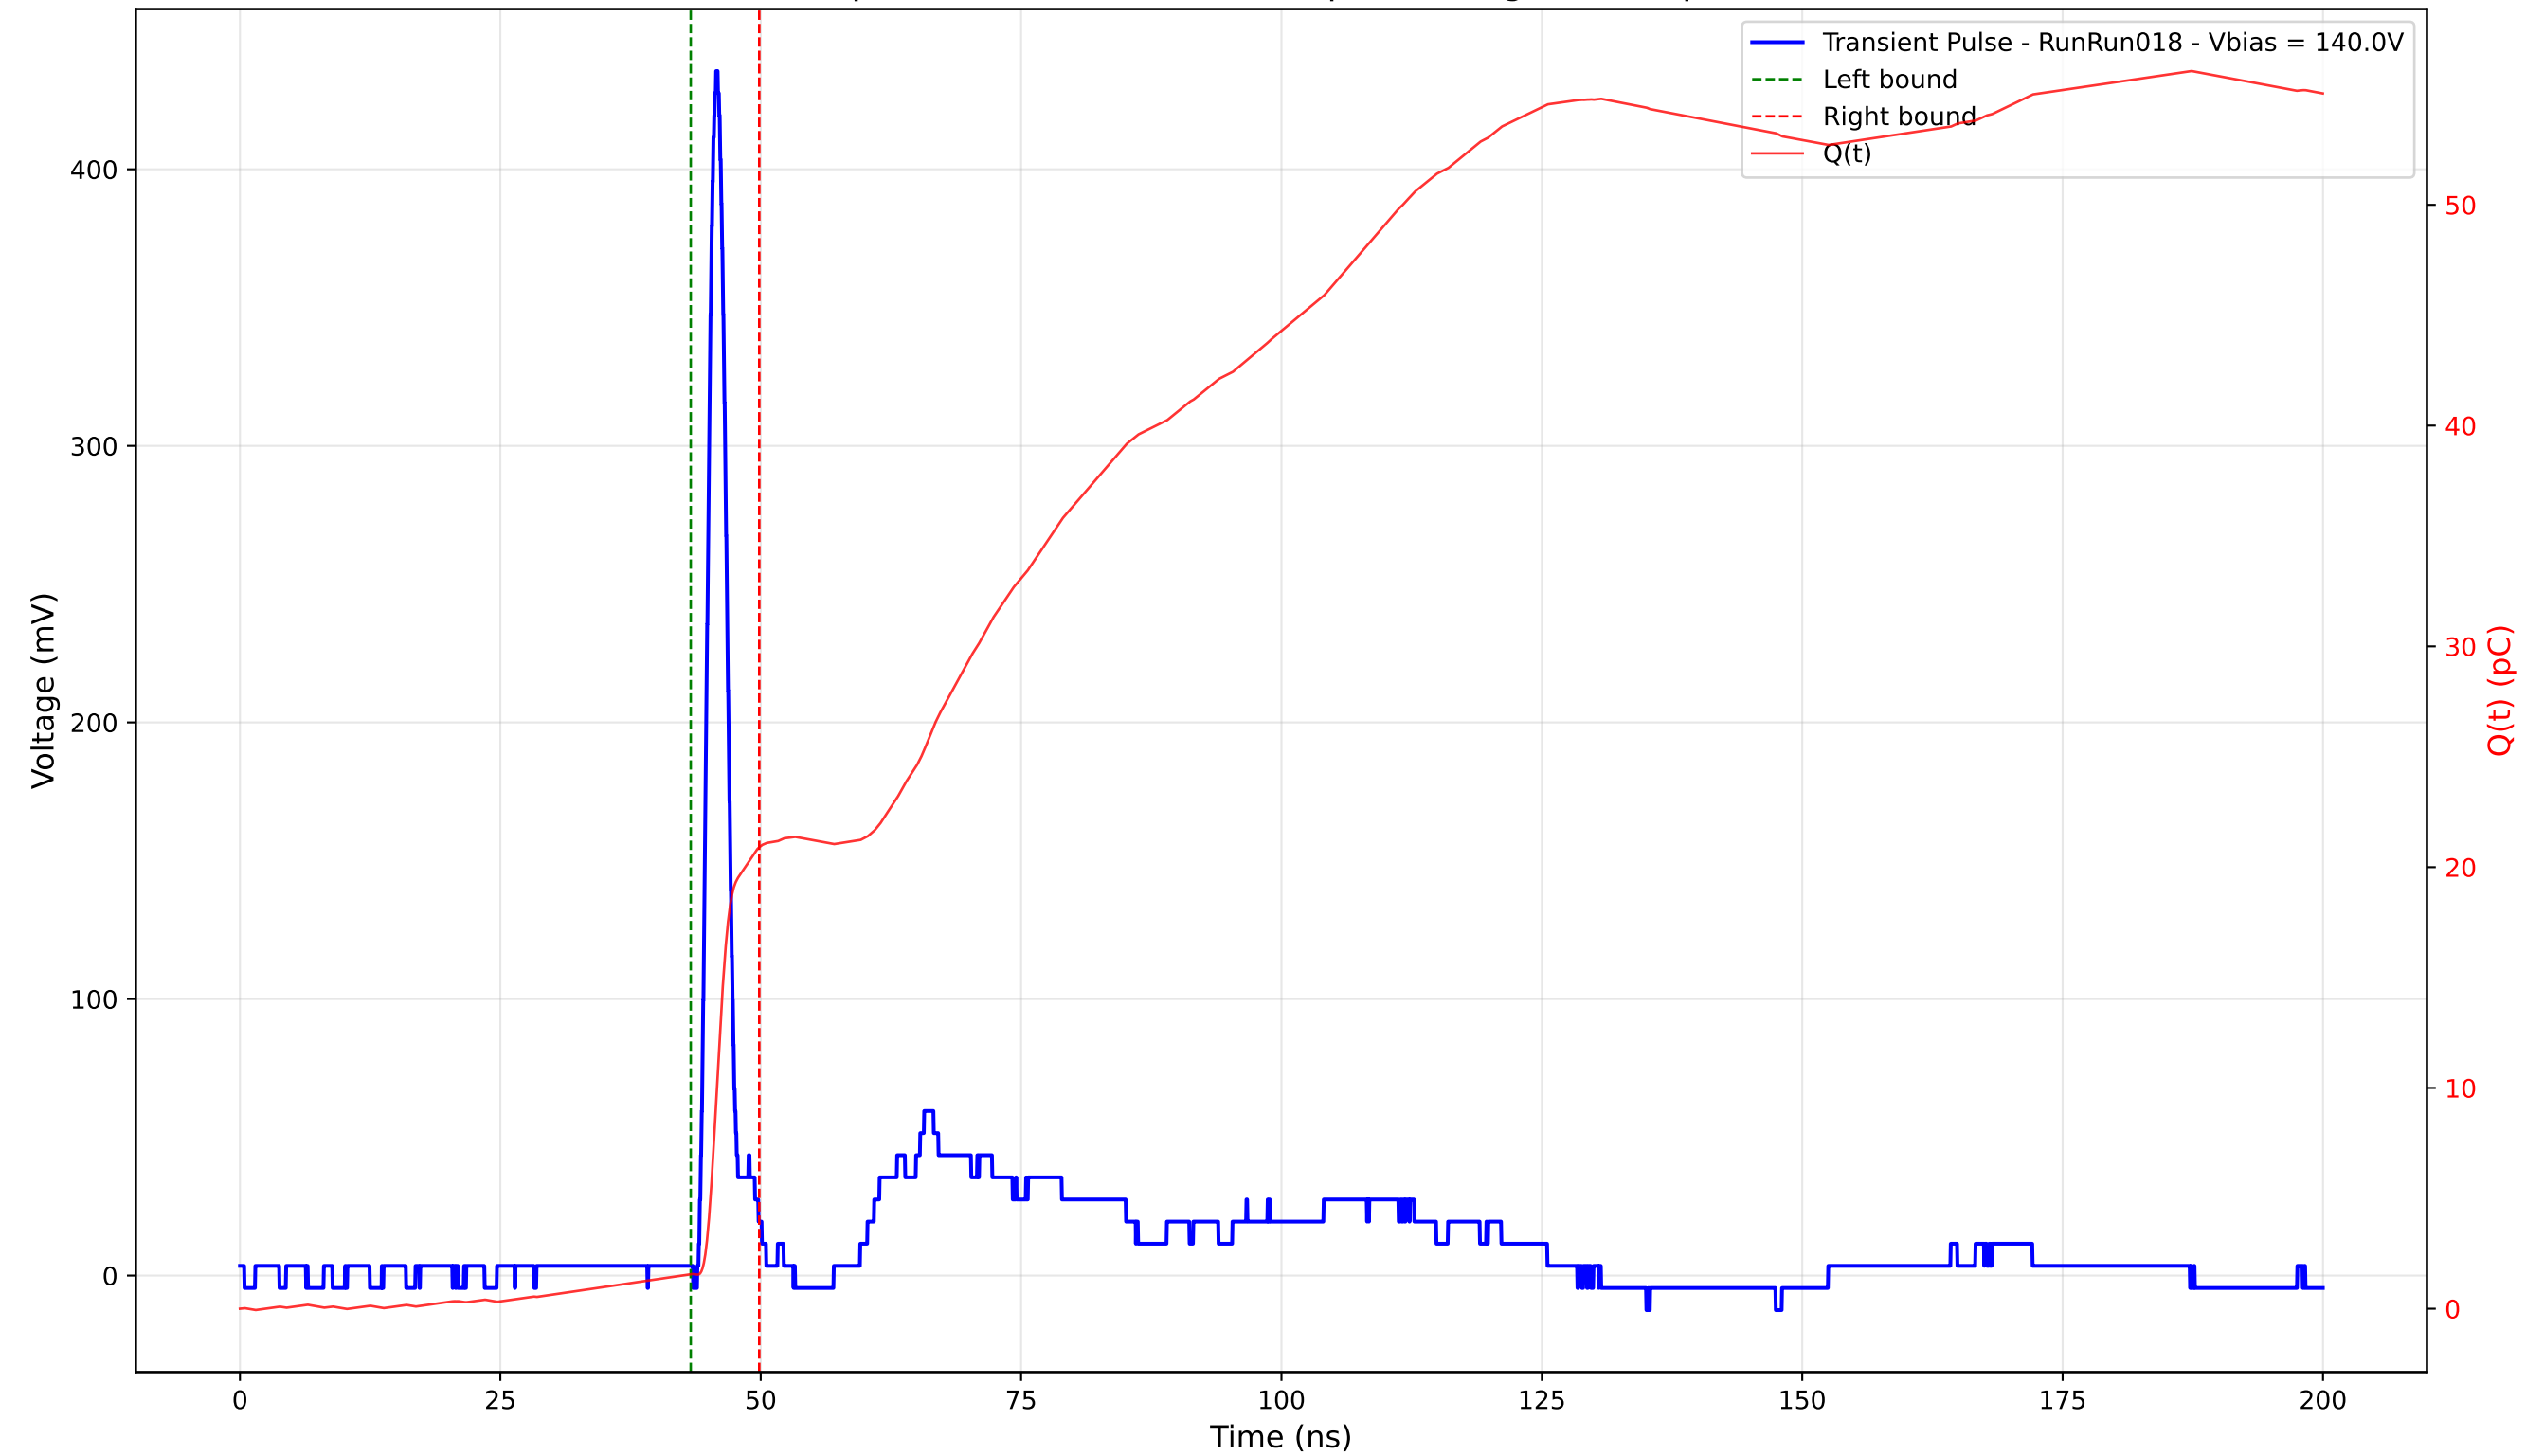


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 19.13 pC - Rise Time: 1.10 ns

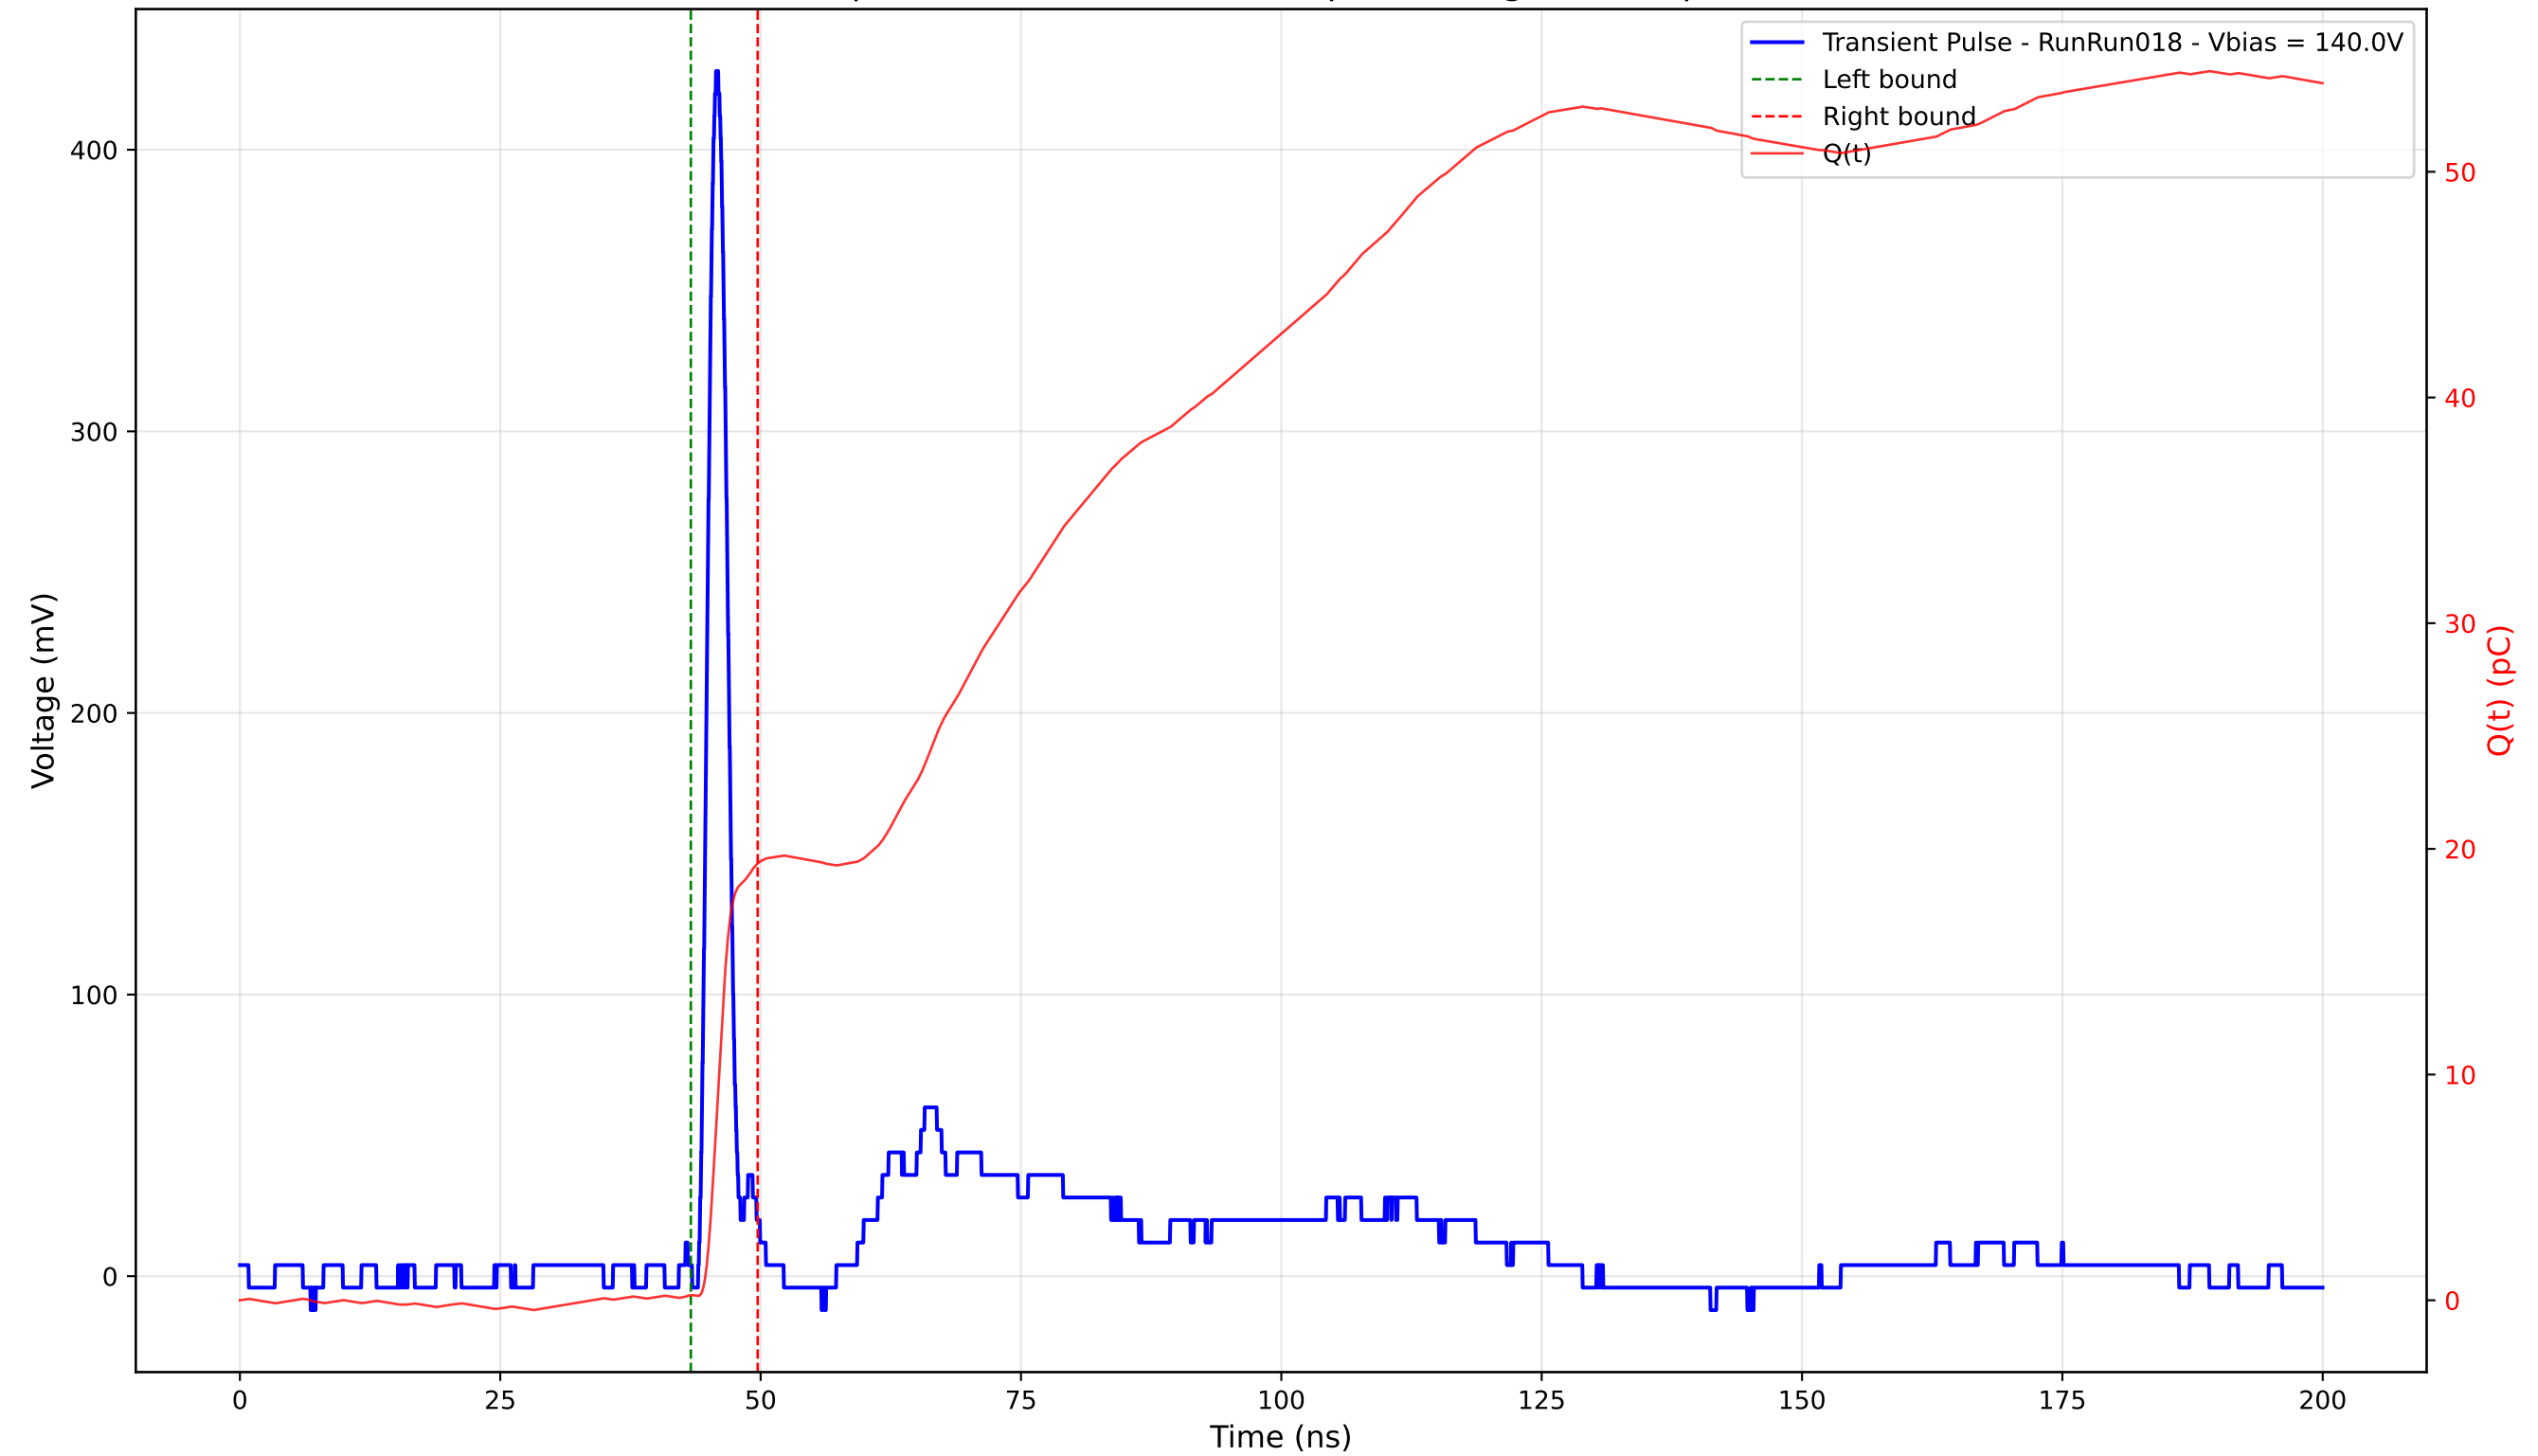


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 19.62 pC - Rise Time: 1.13 ns

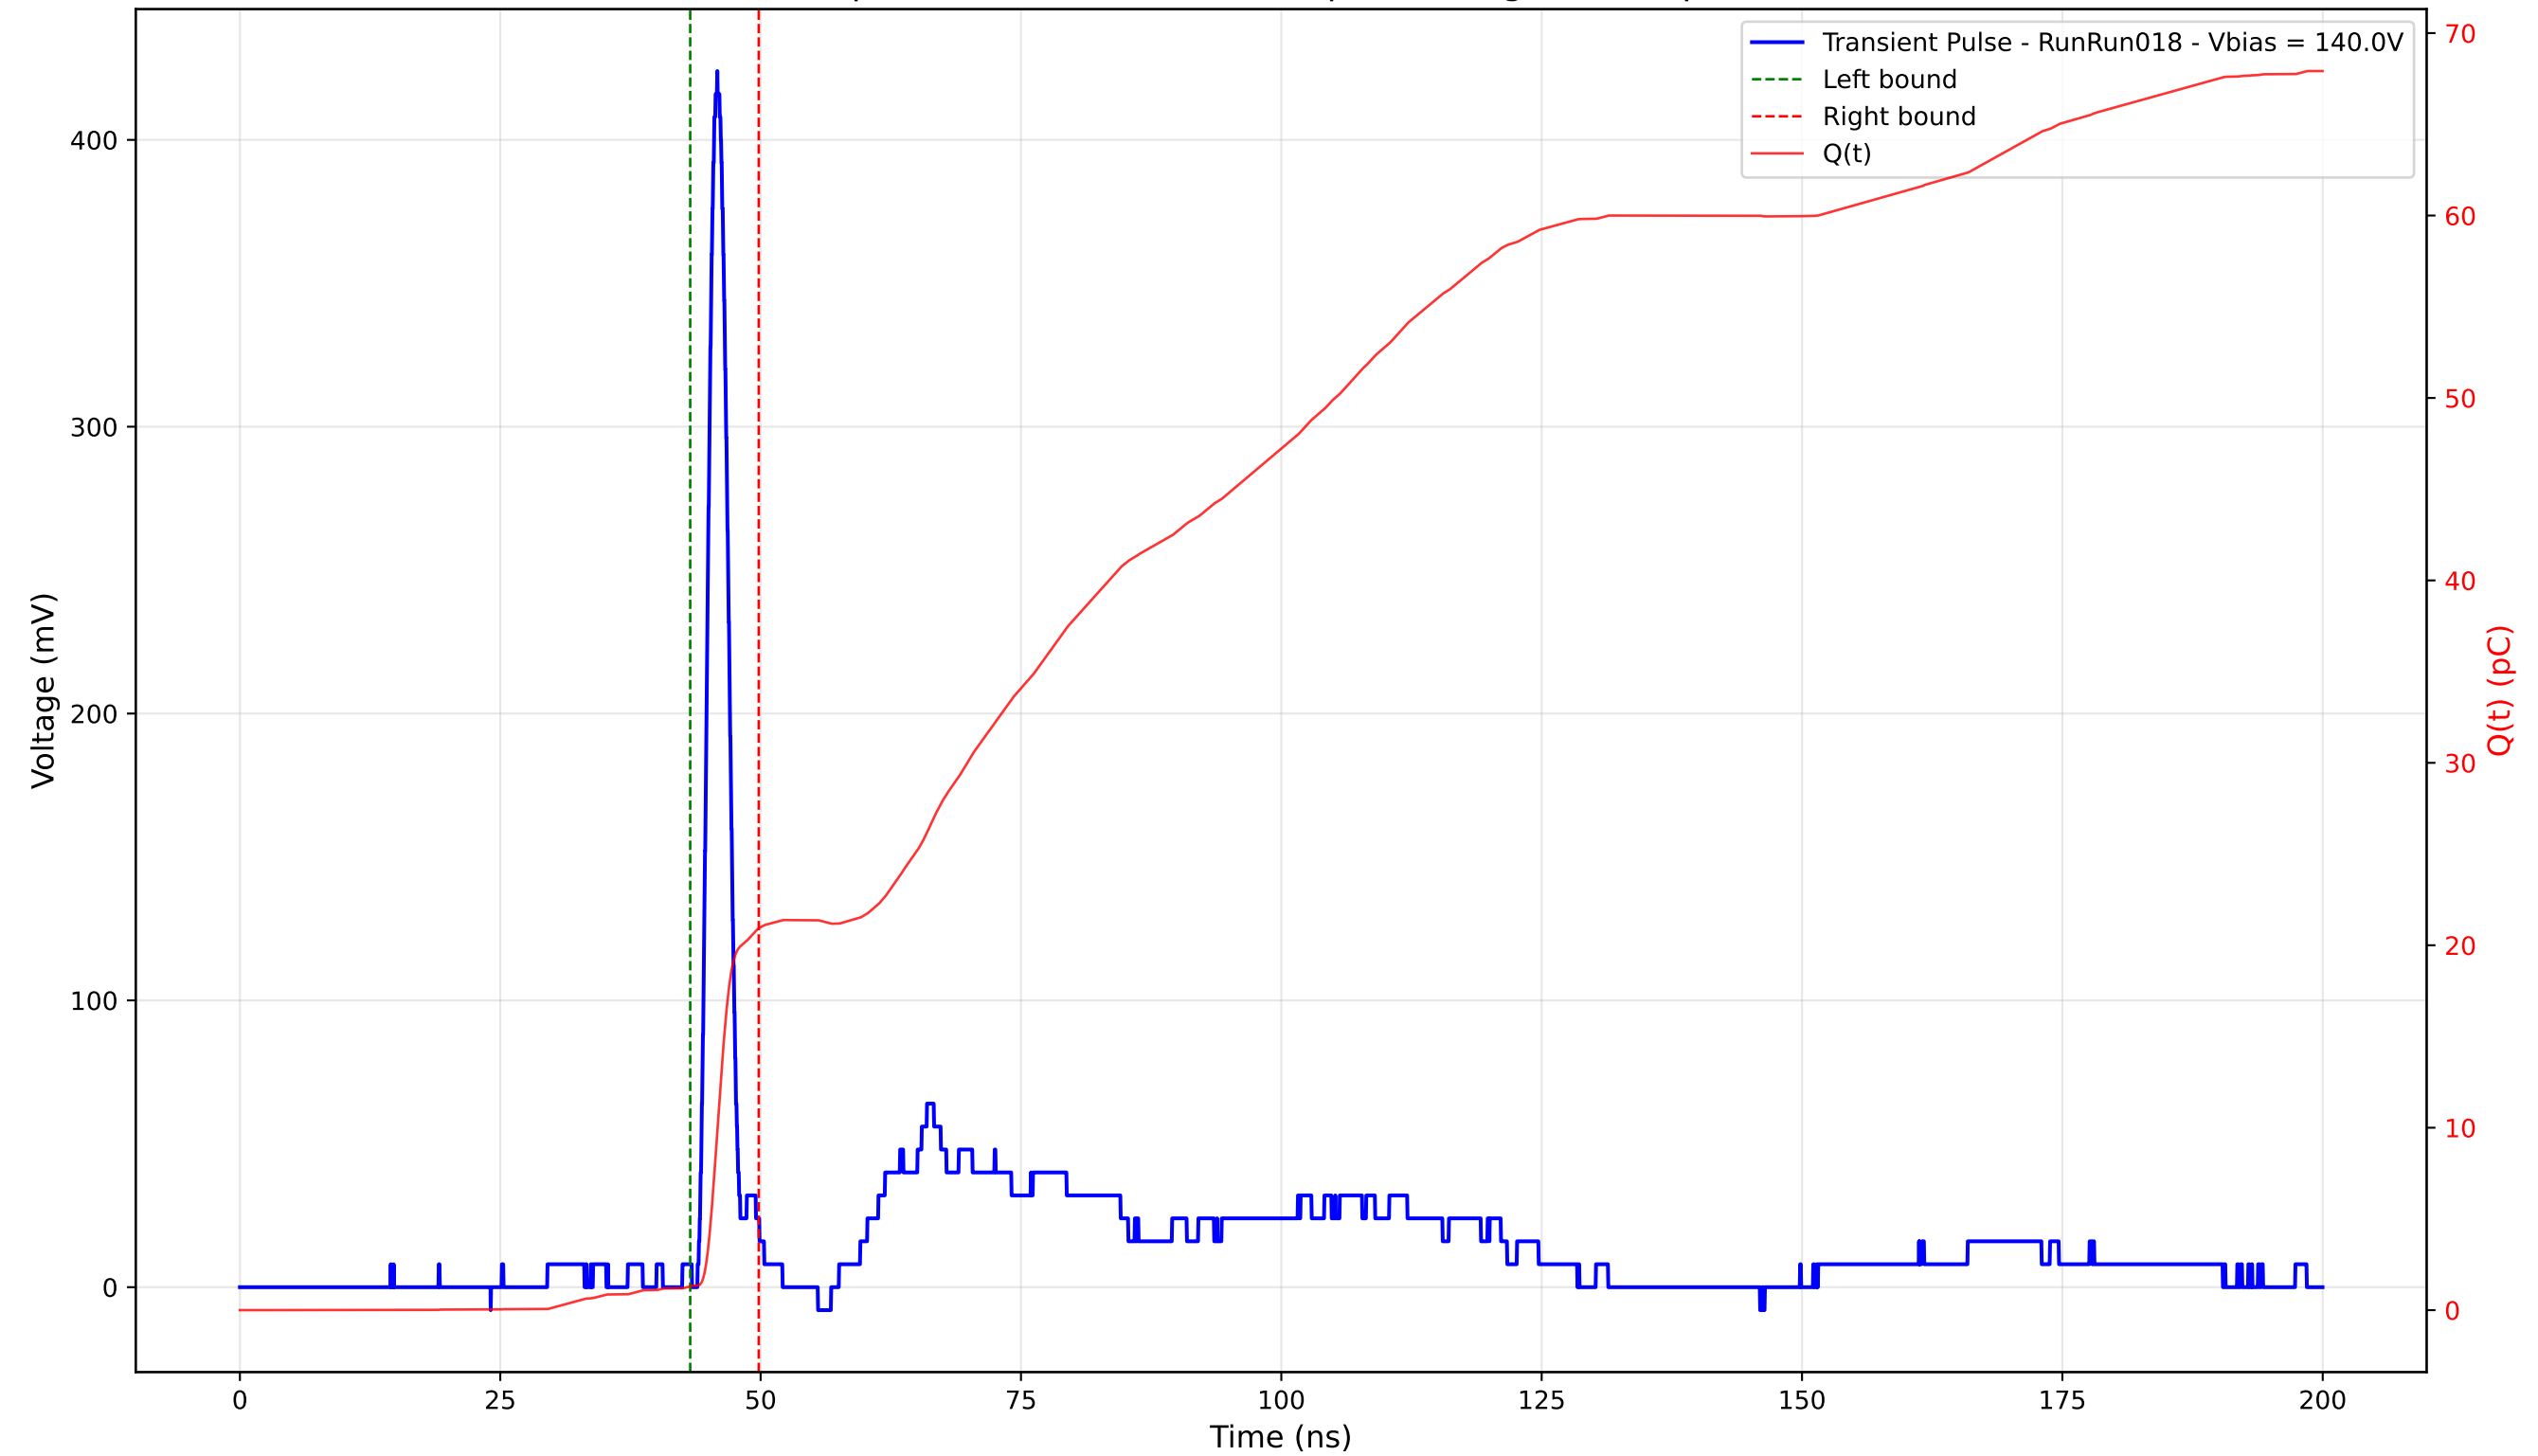


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 19.05 pC - Rise Time: 1.11 ns

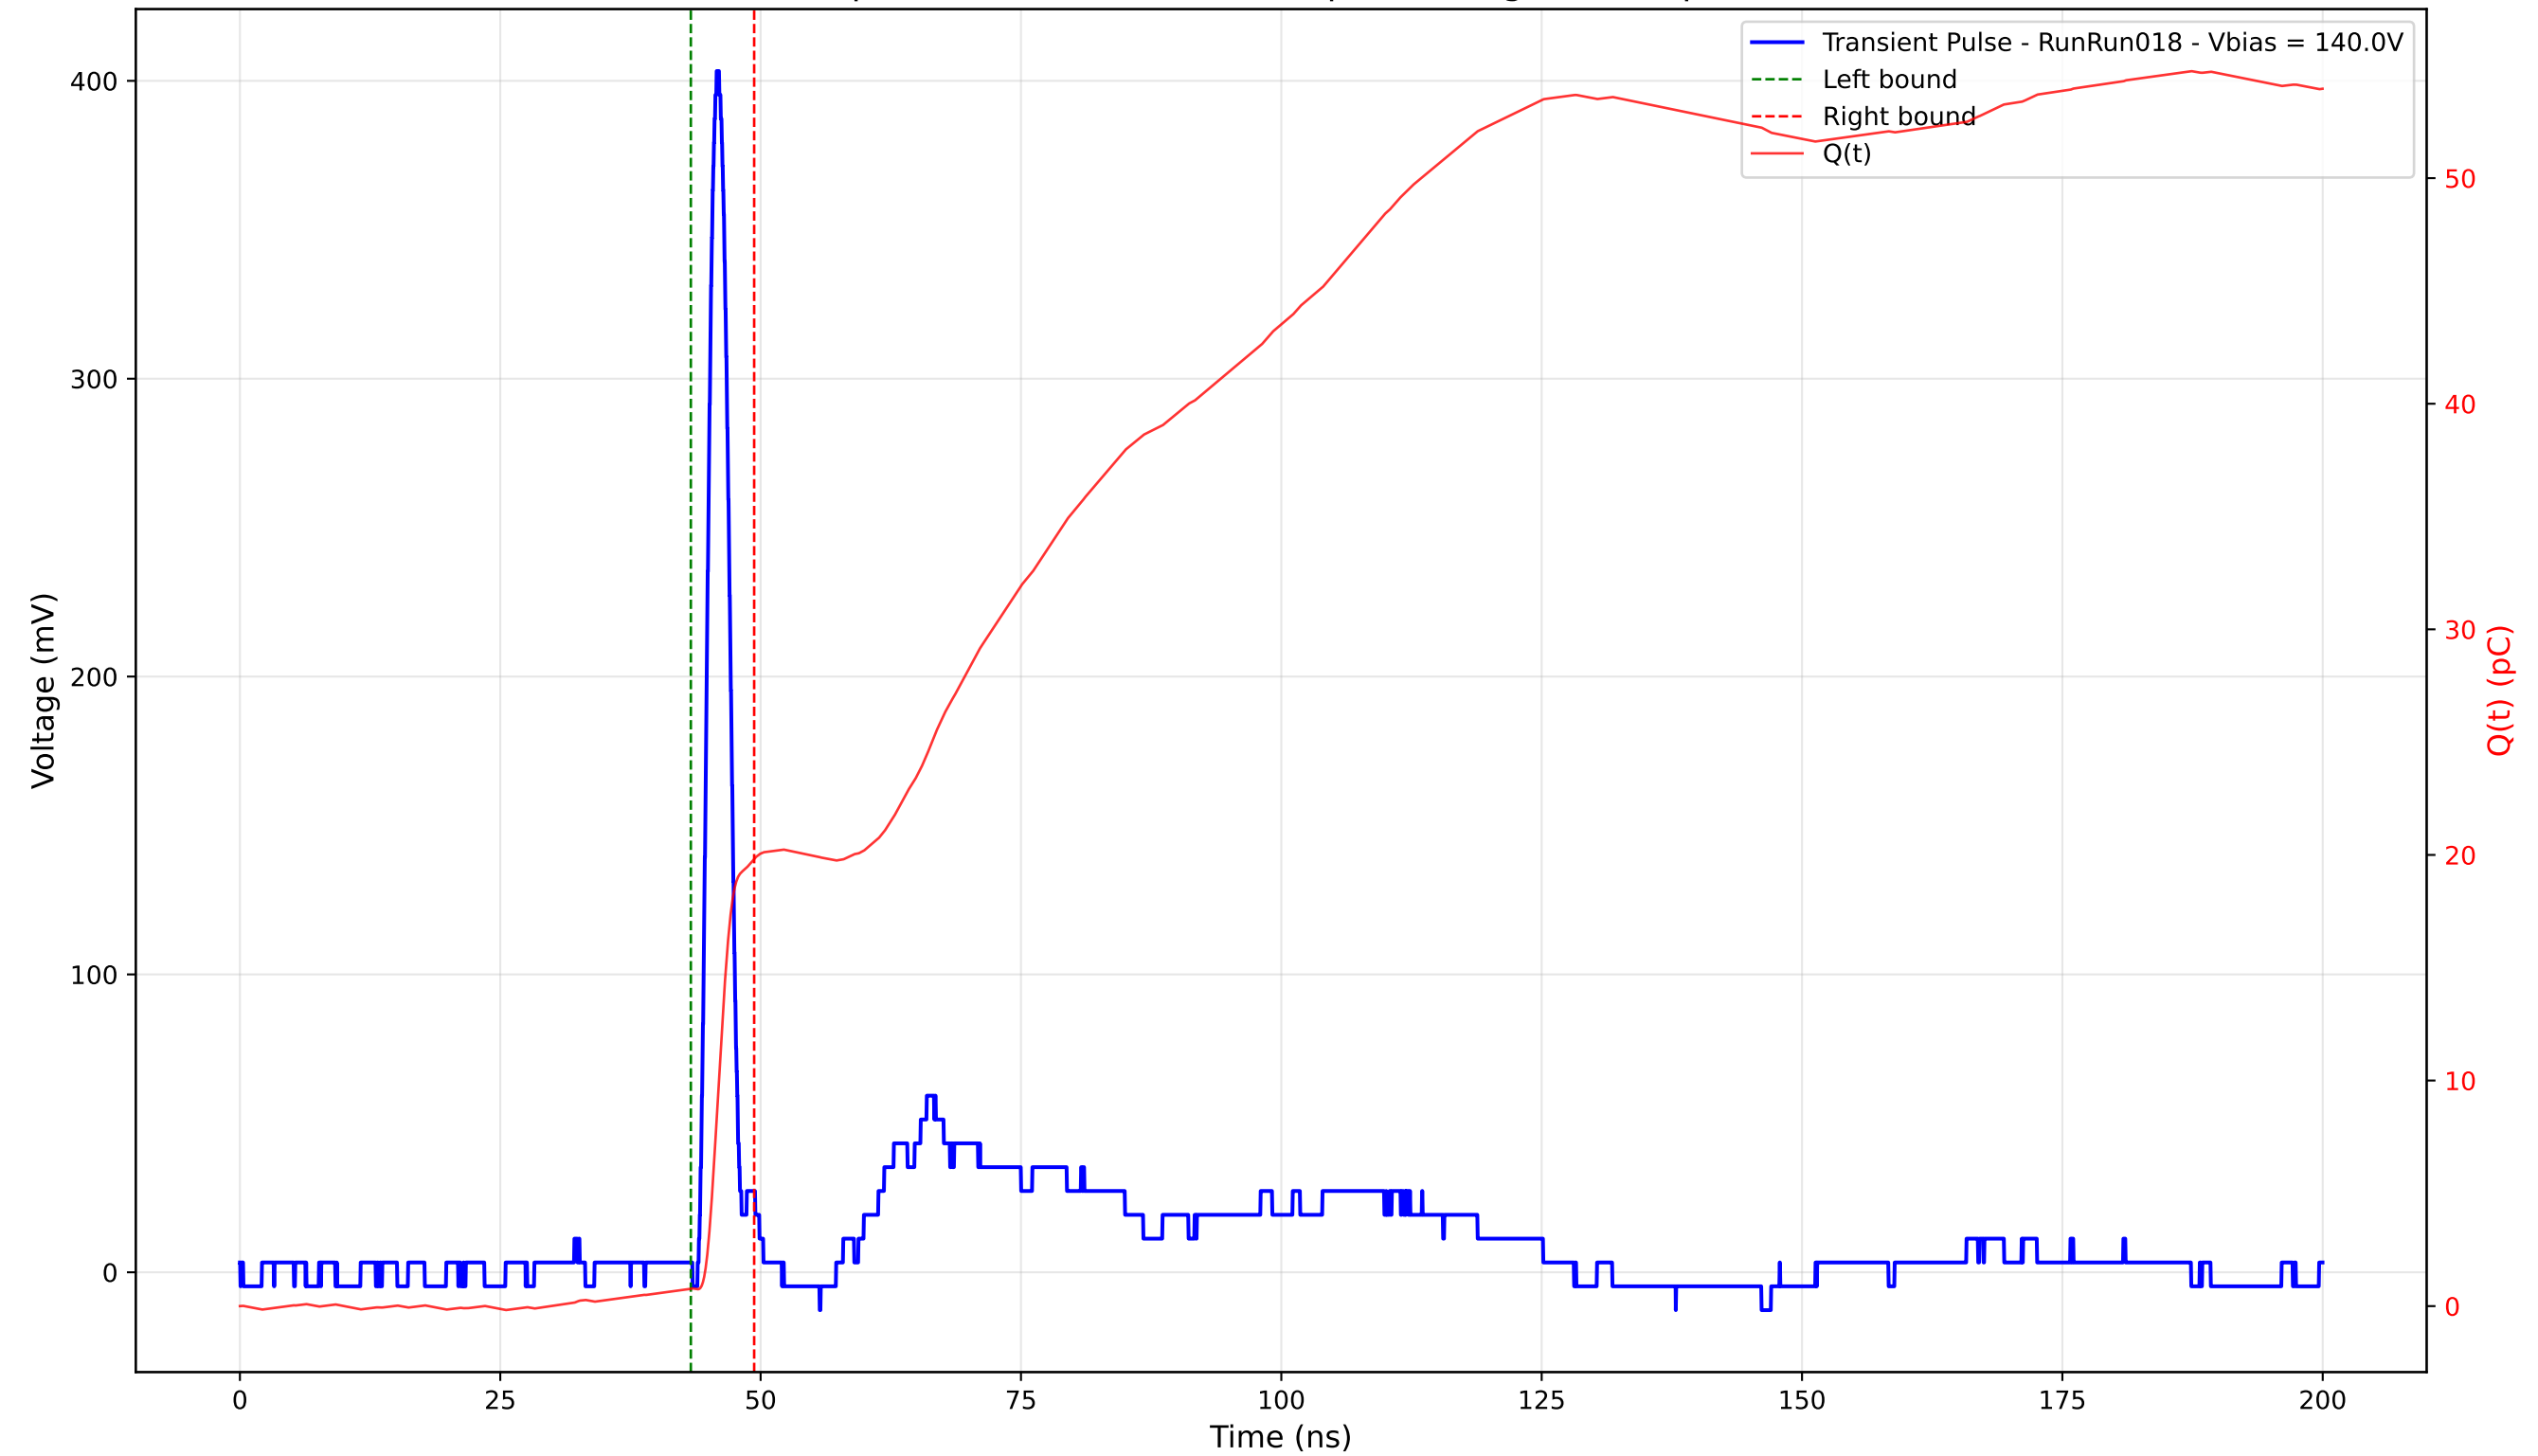


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 18.29 pC - Rise Time: 1.17 ns

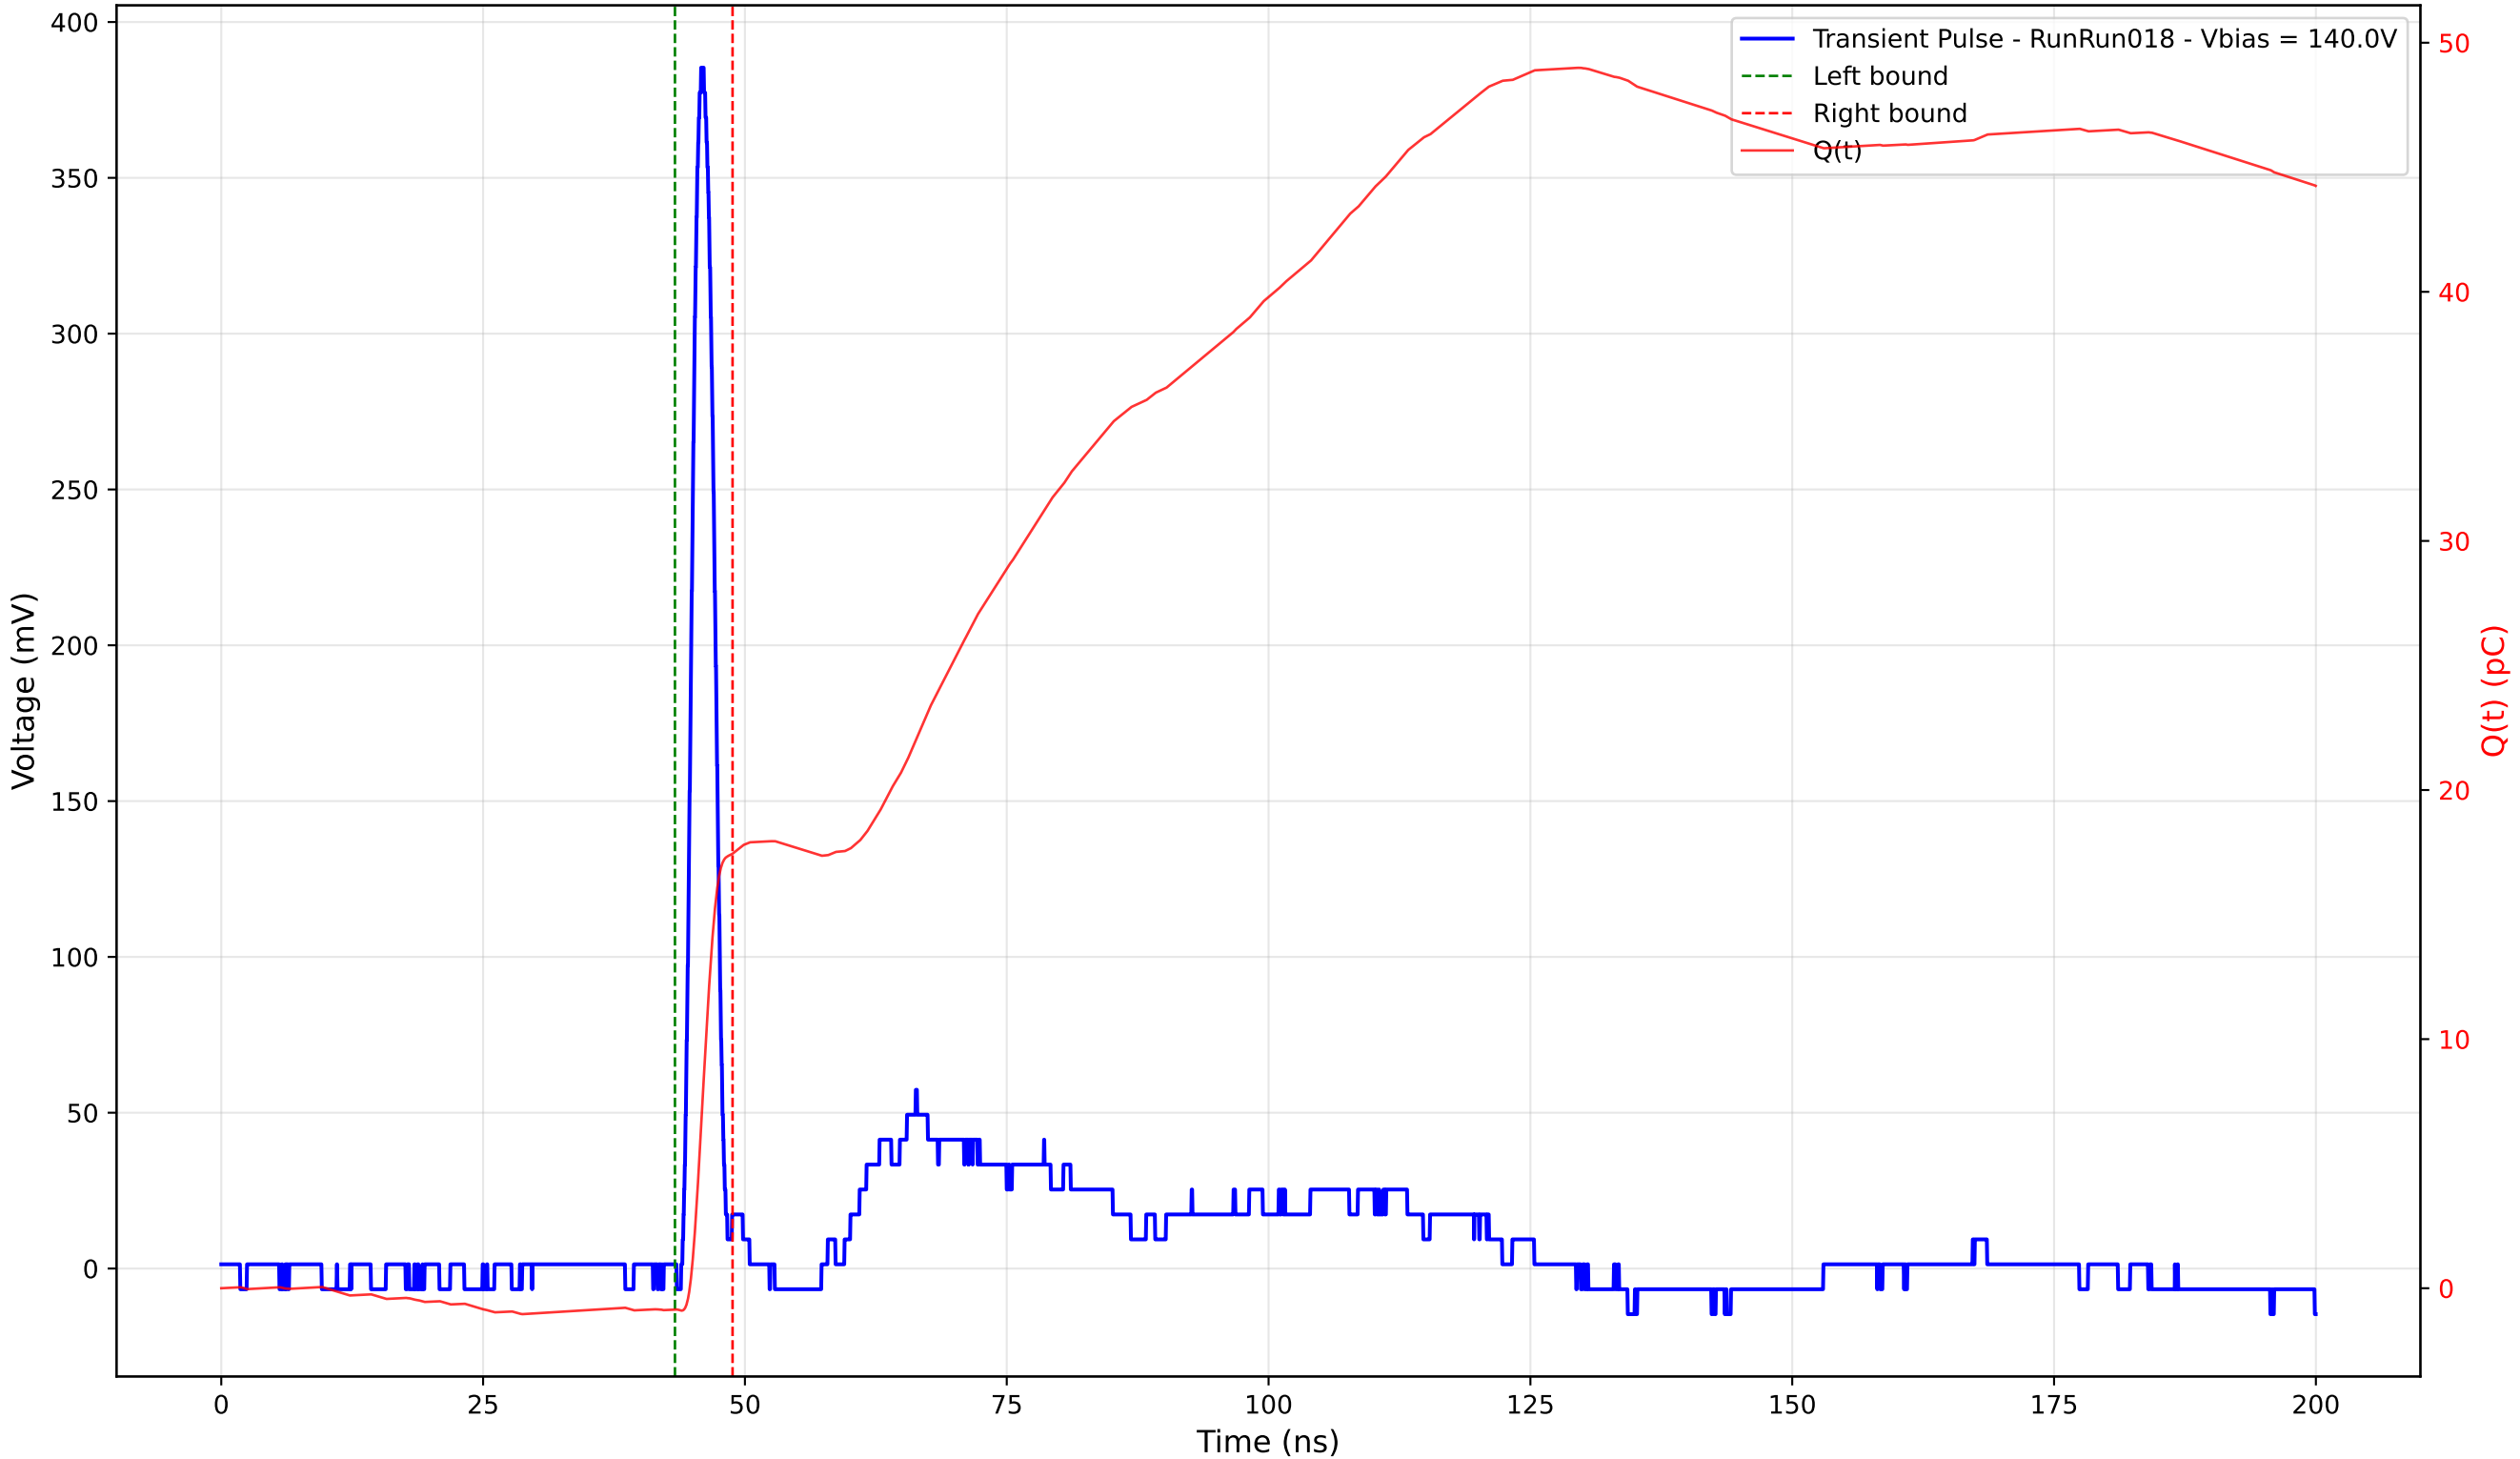


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 18.75 pC - Rise Time: 1.20 ns

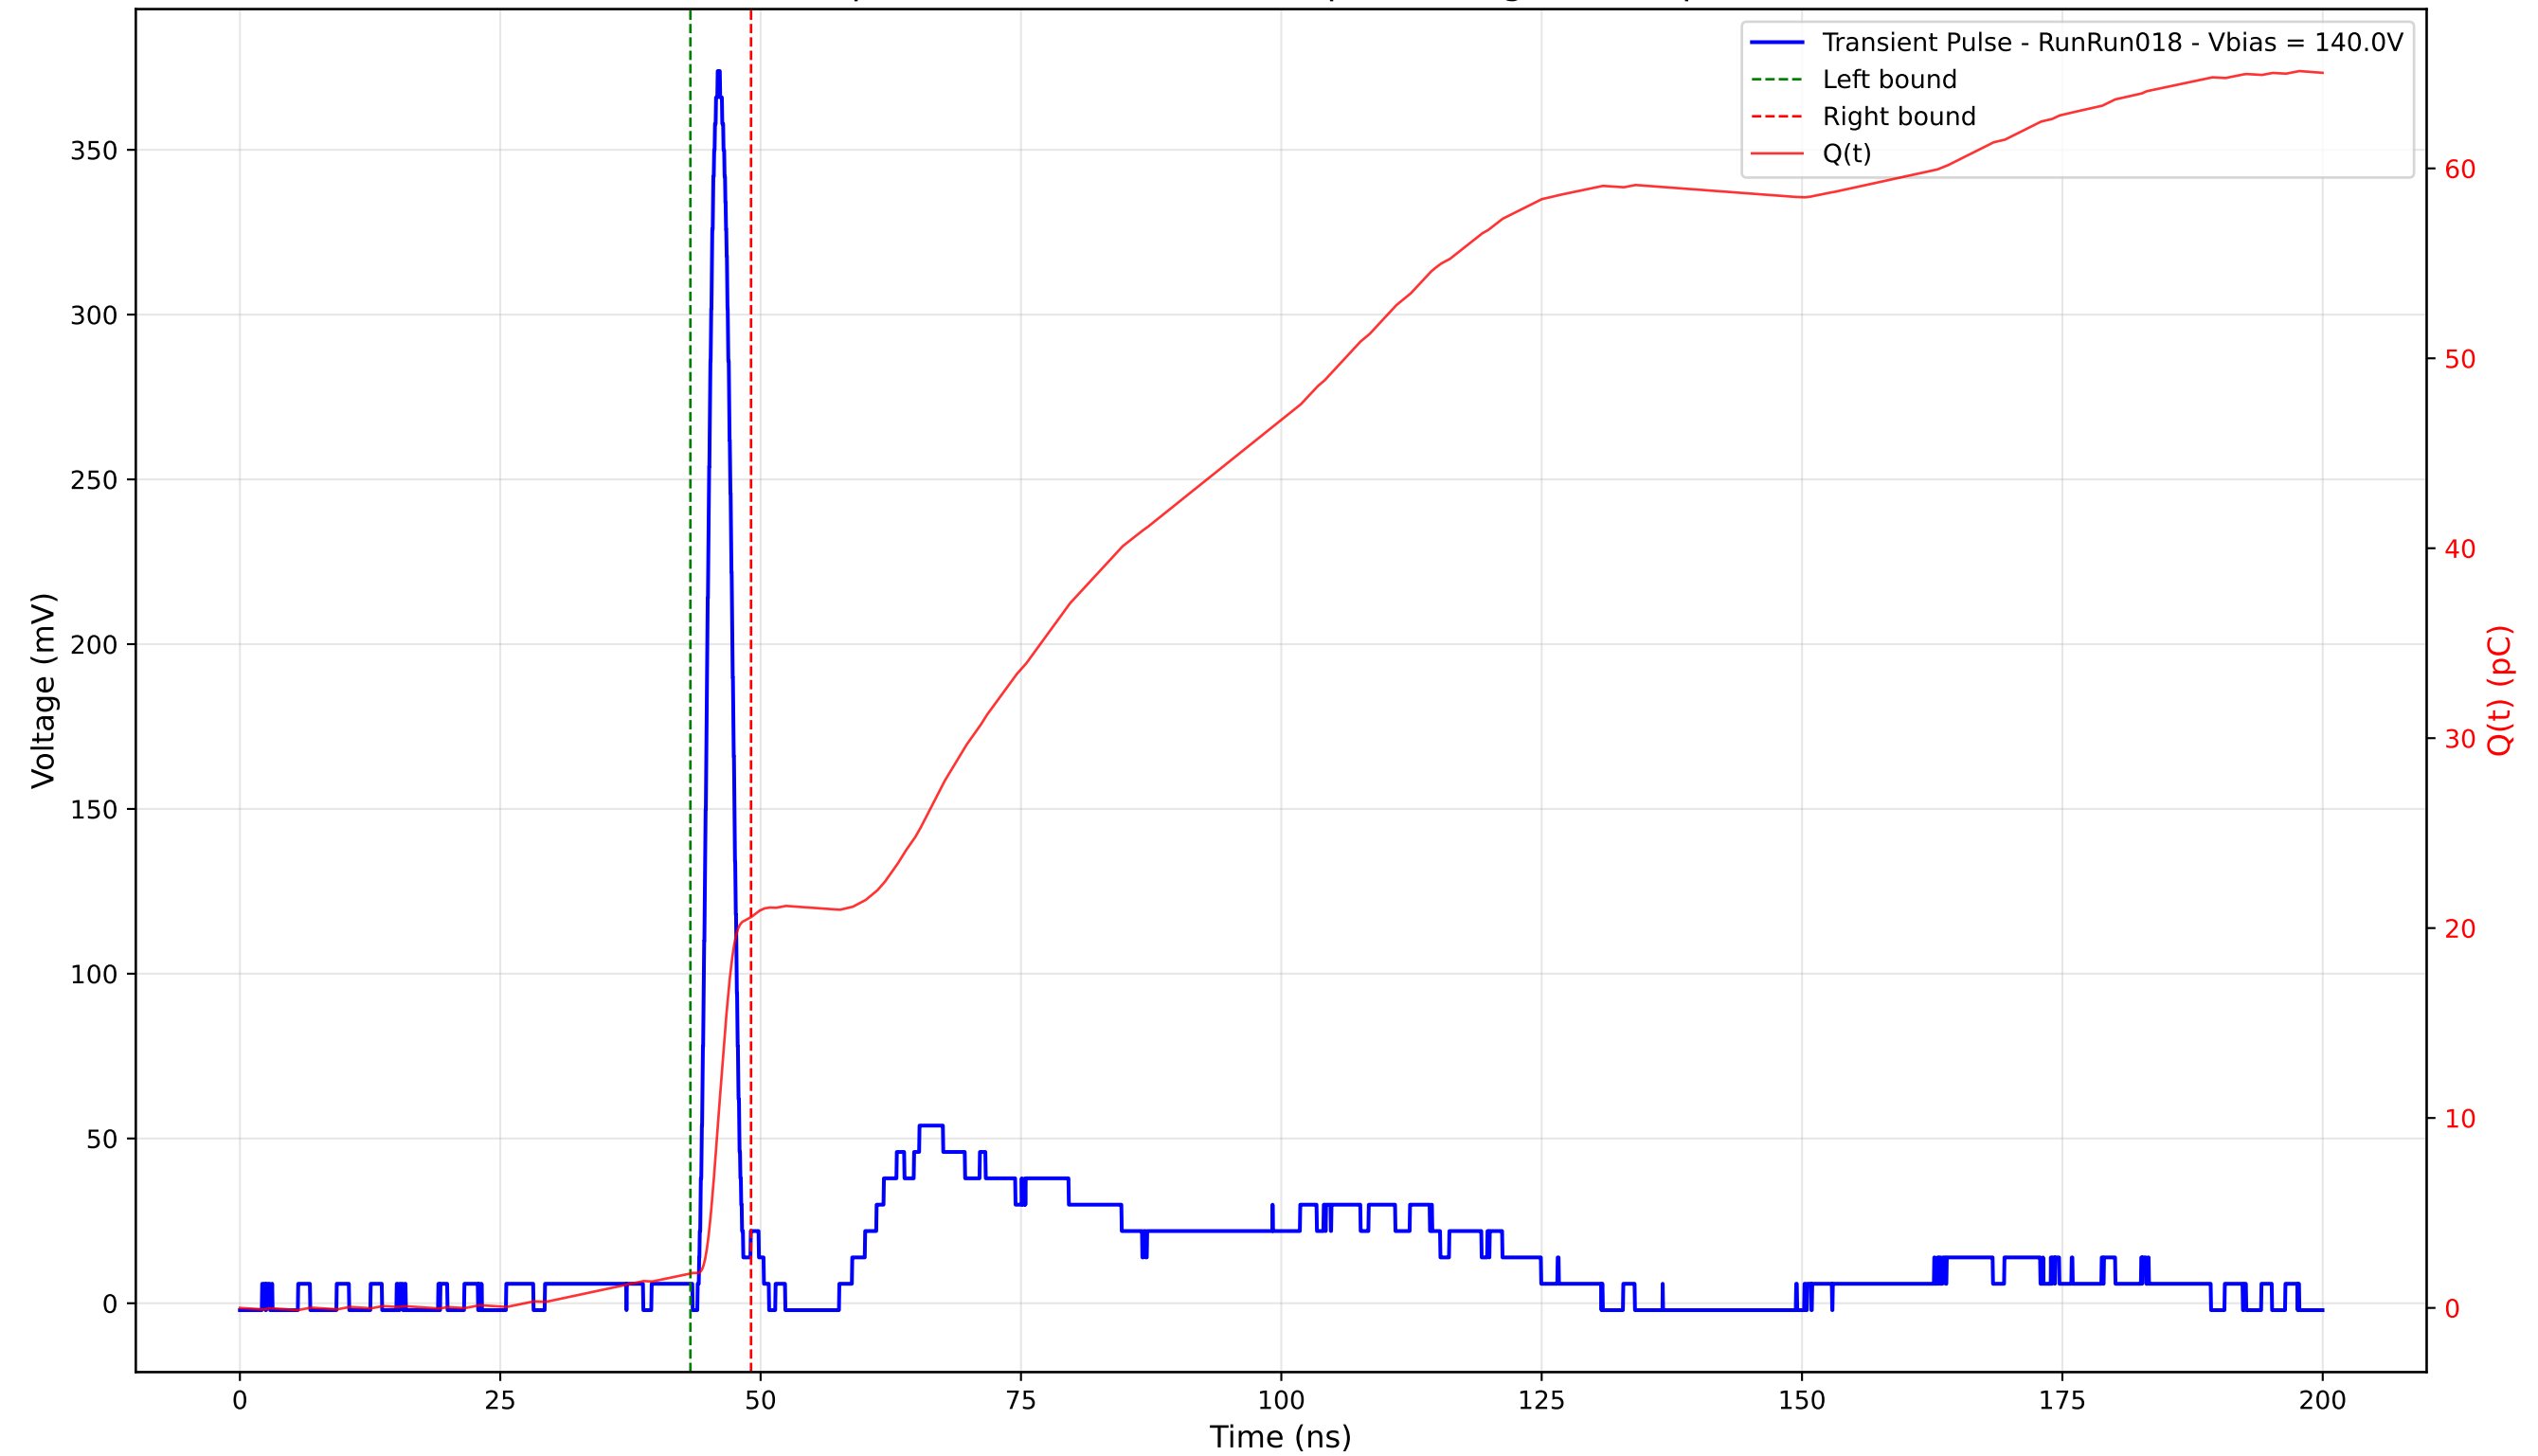


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 18.50 pC - Rise Time: 1.16 ns

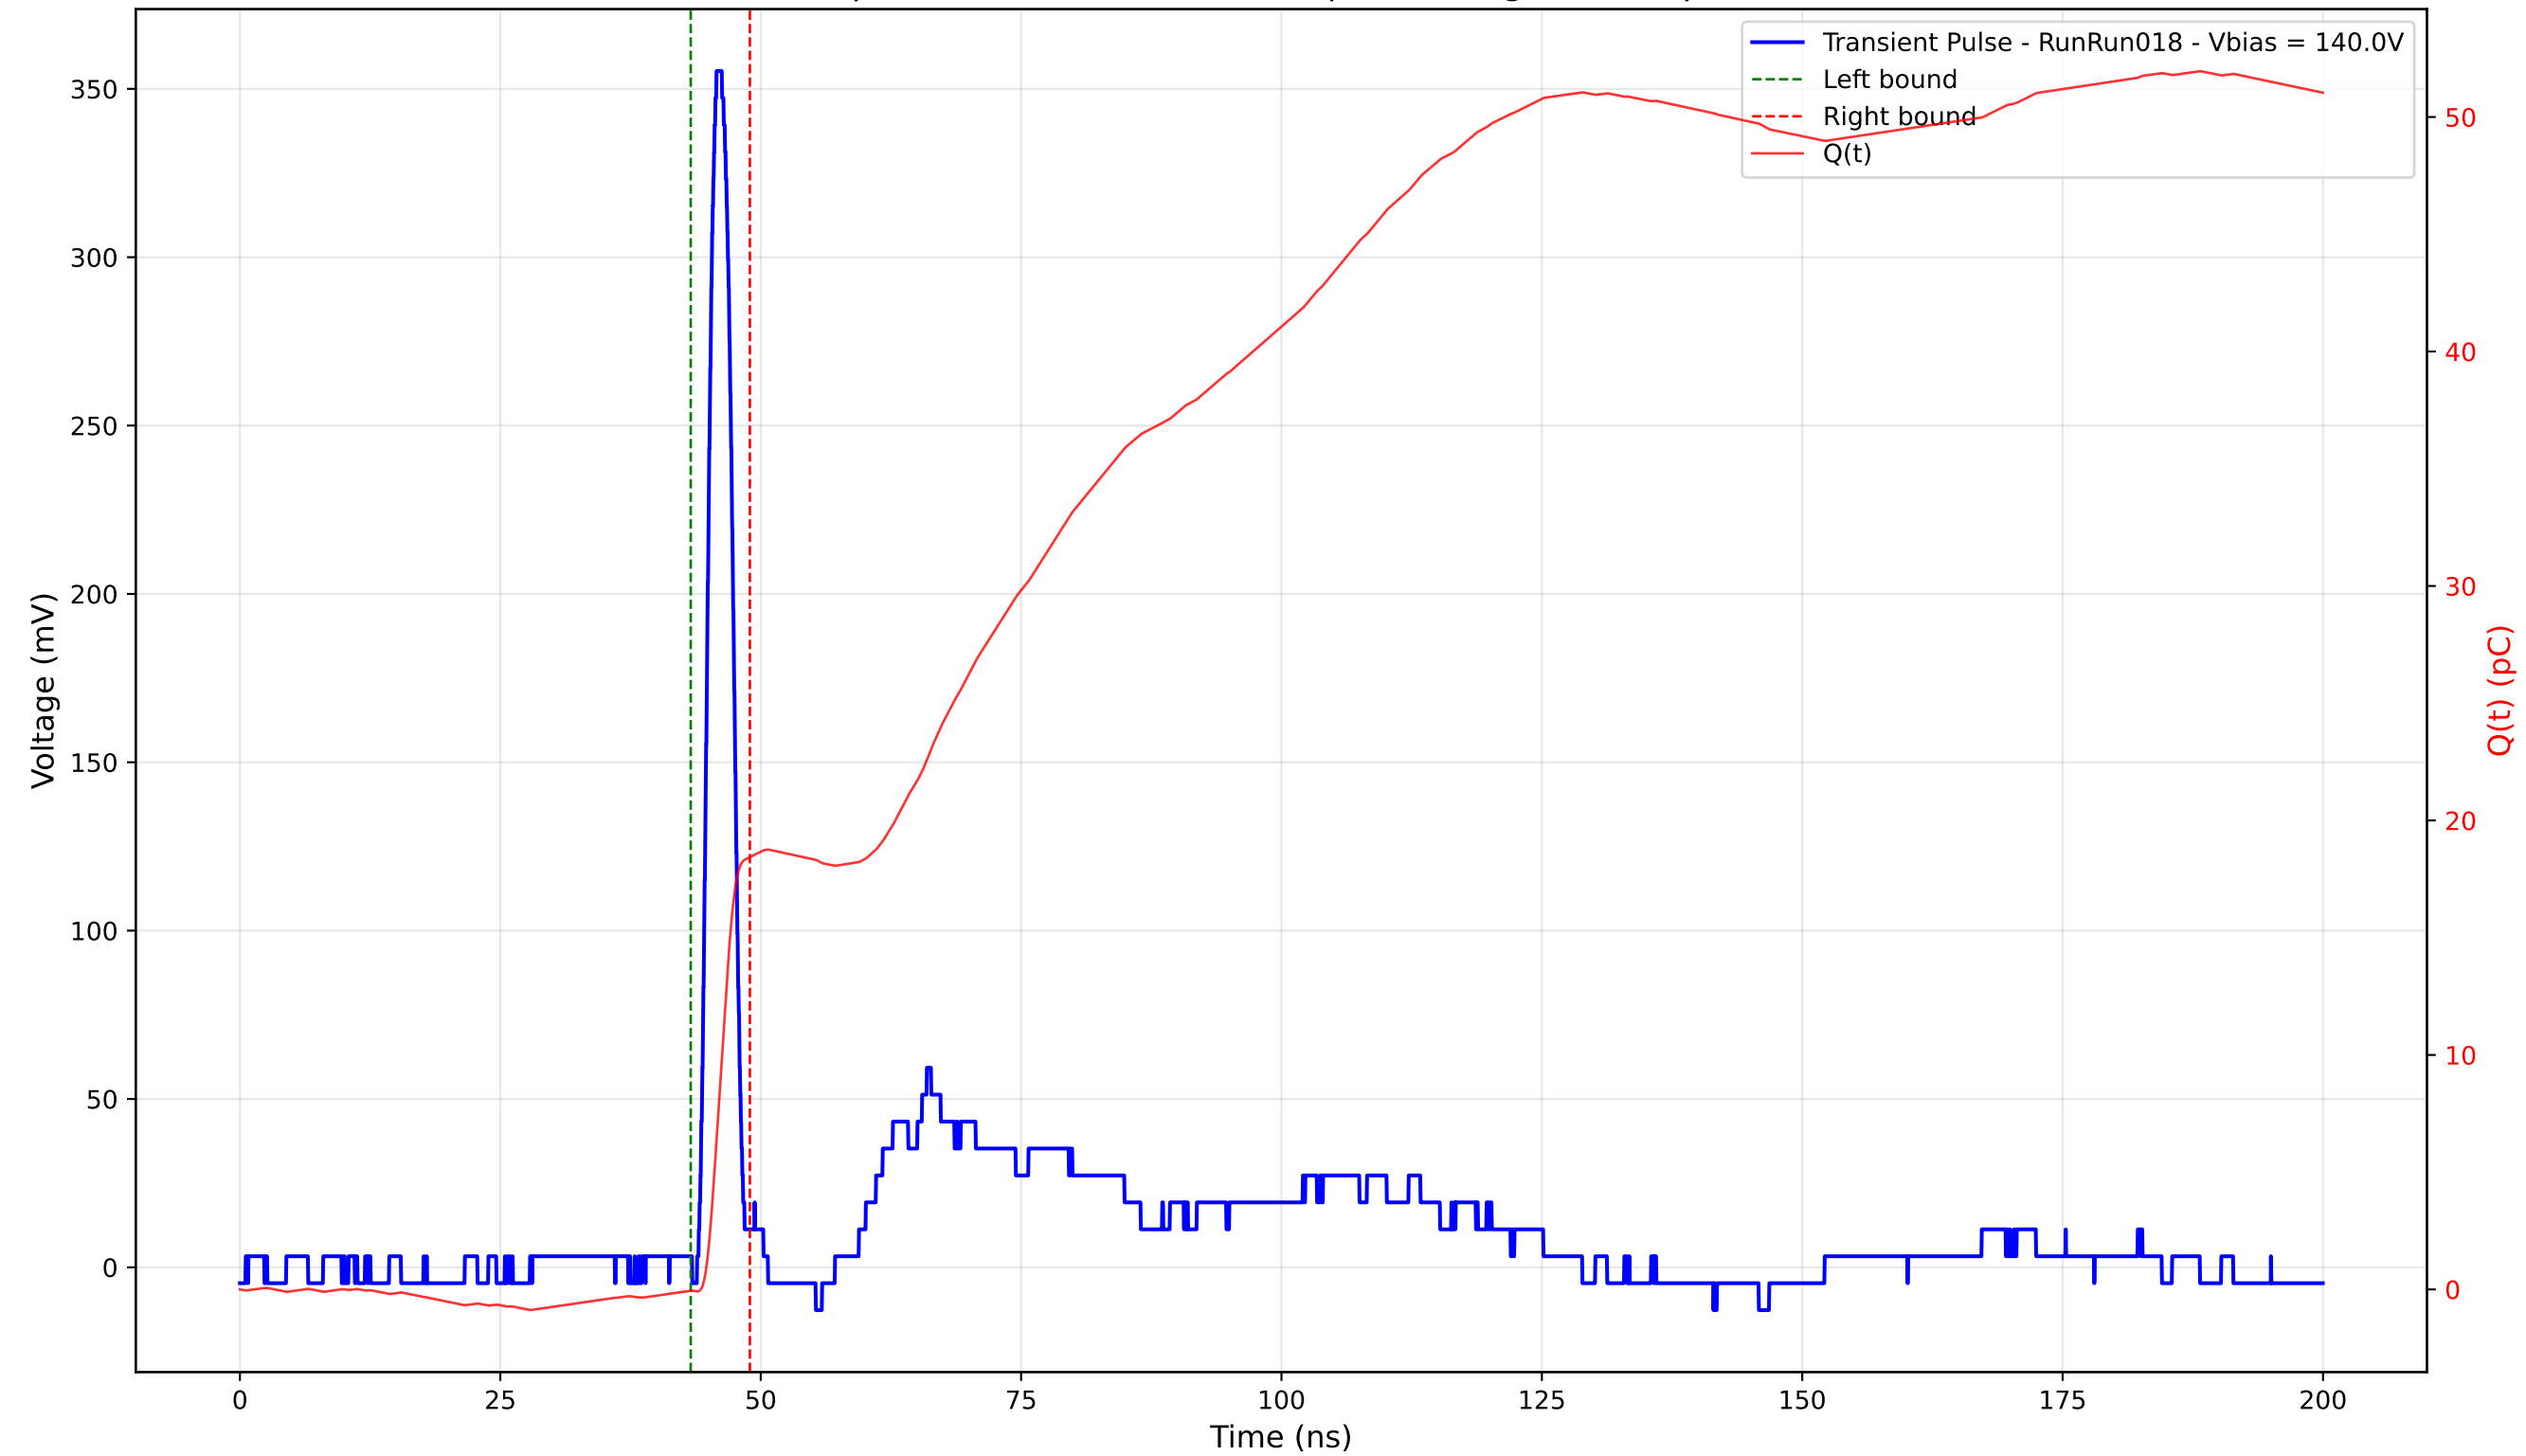


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 18.26 pC - Rise Time: 1.14 ns

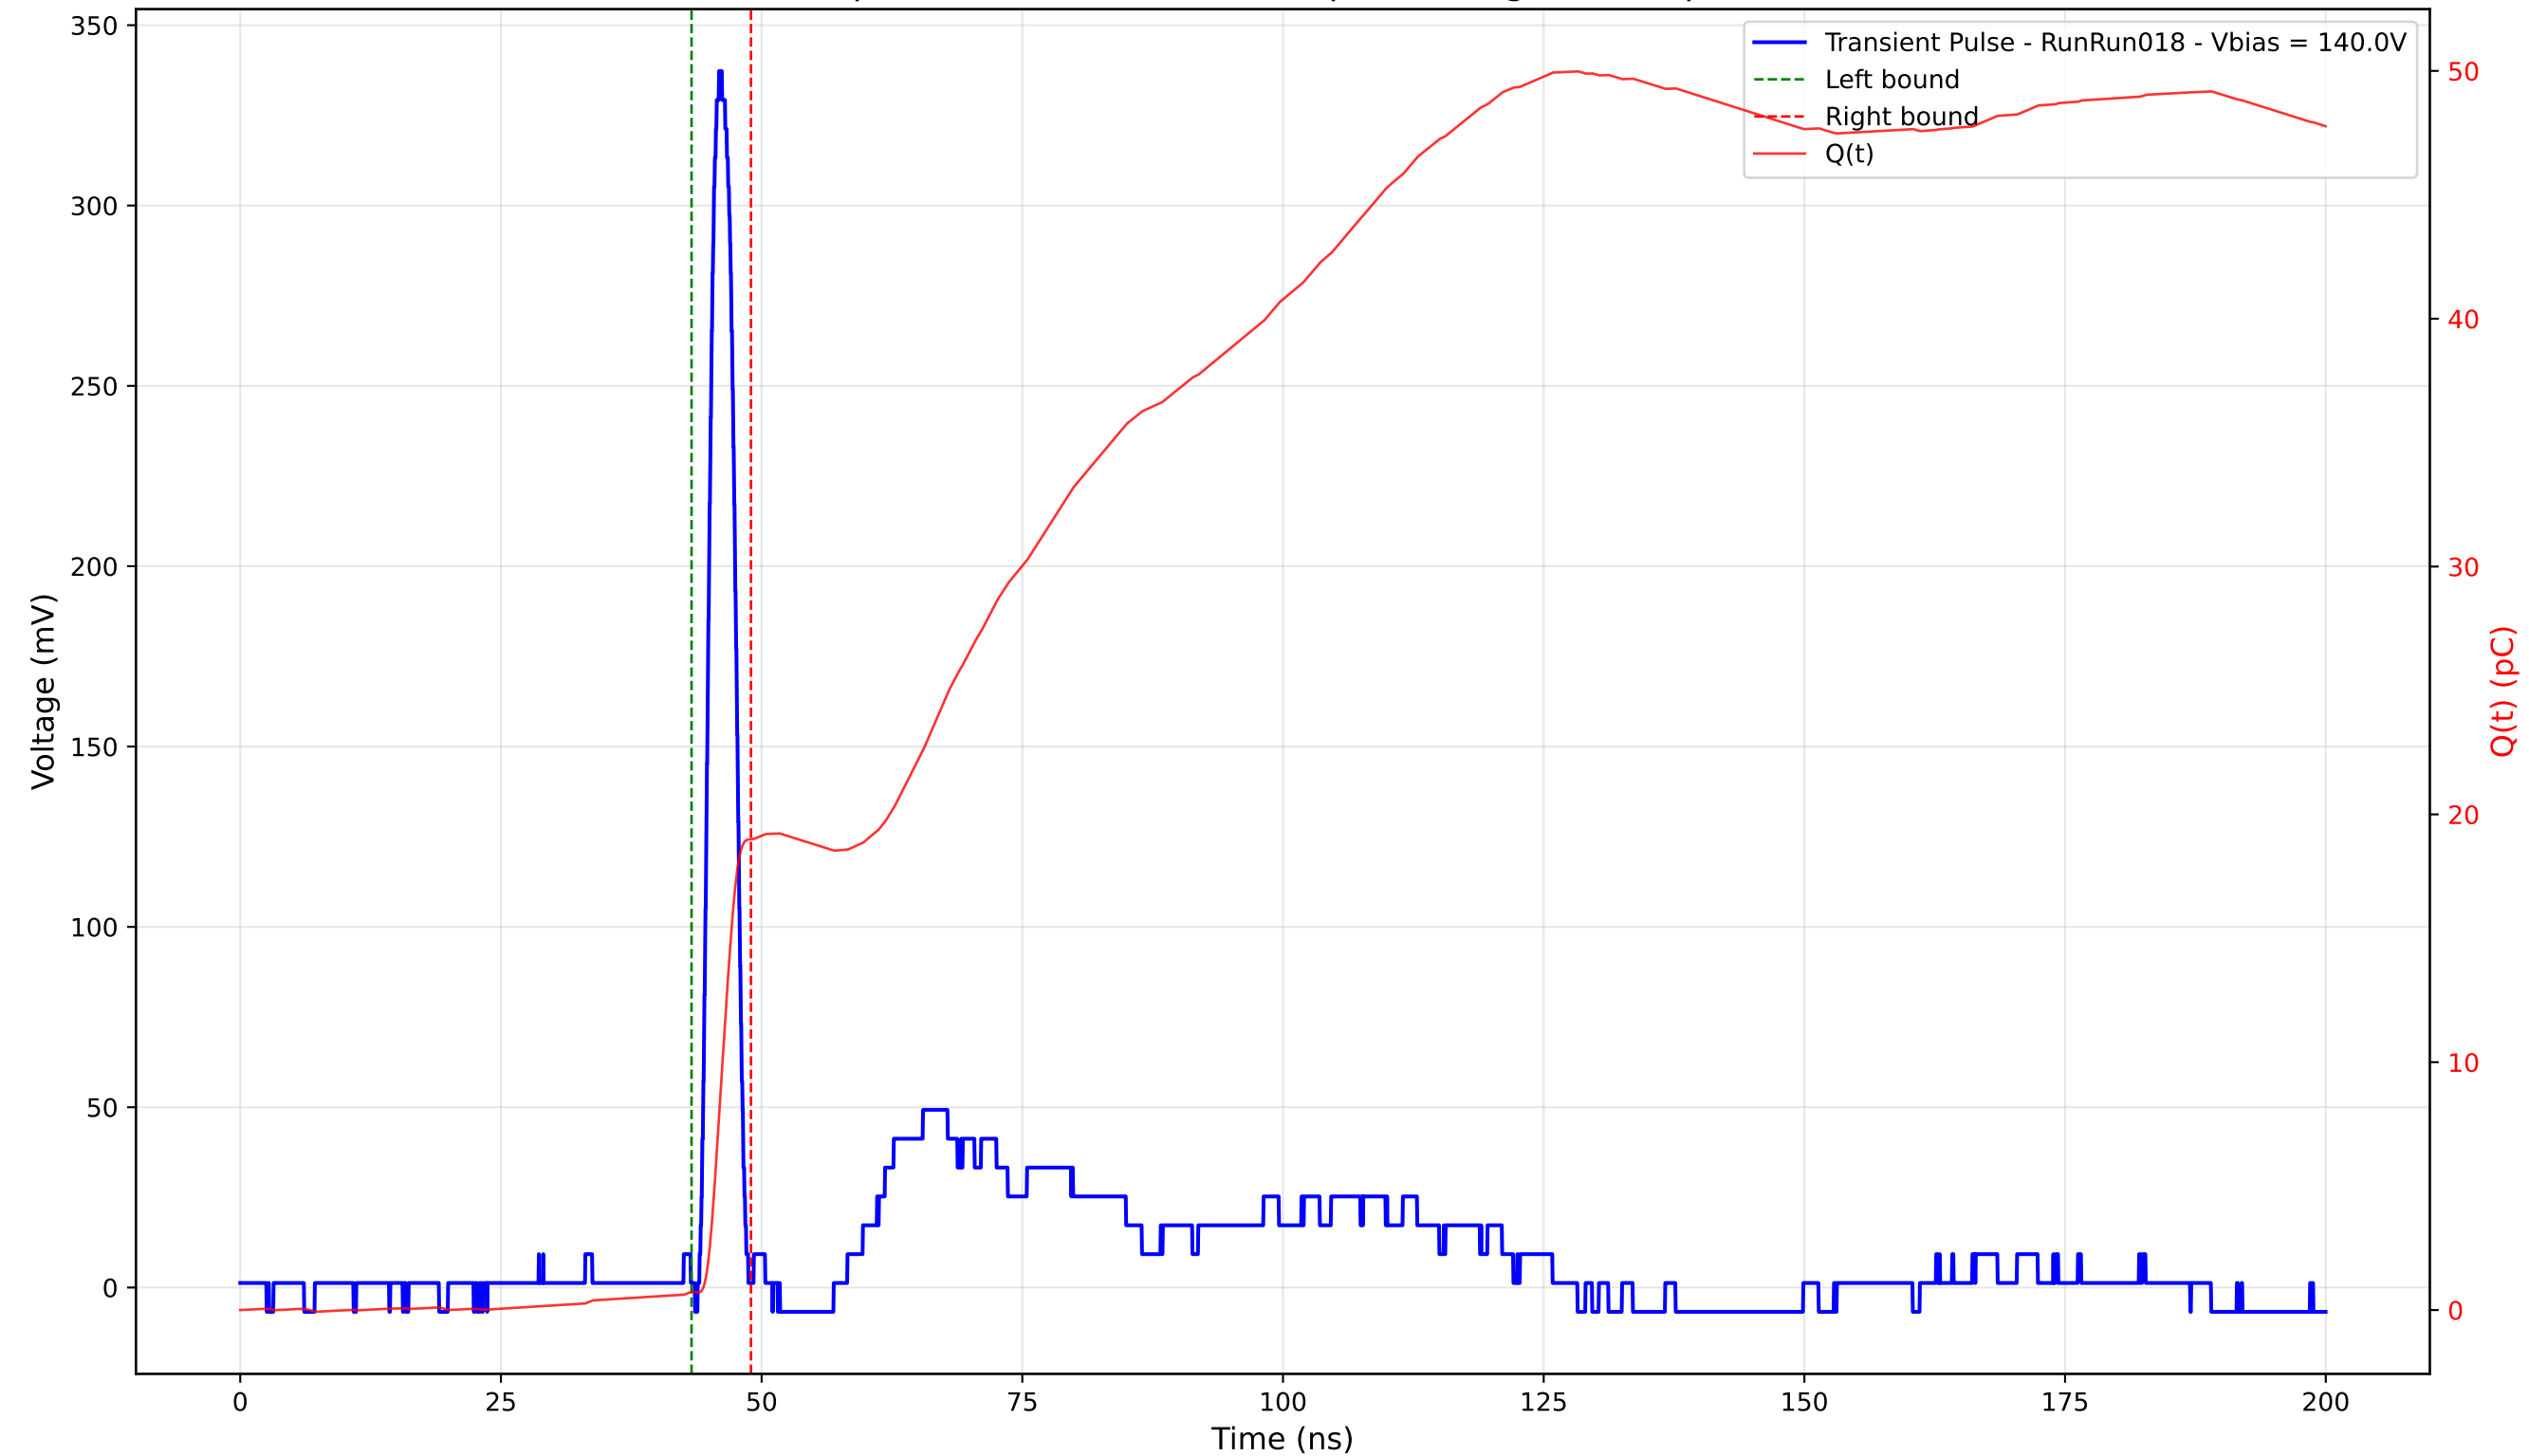


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 18.66 pC - Rise Time: 1.17 ns

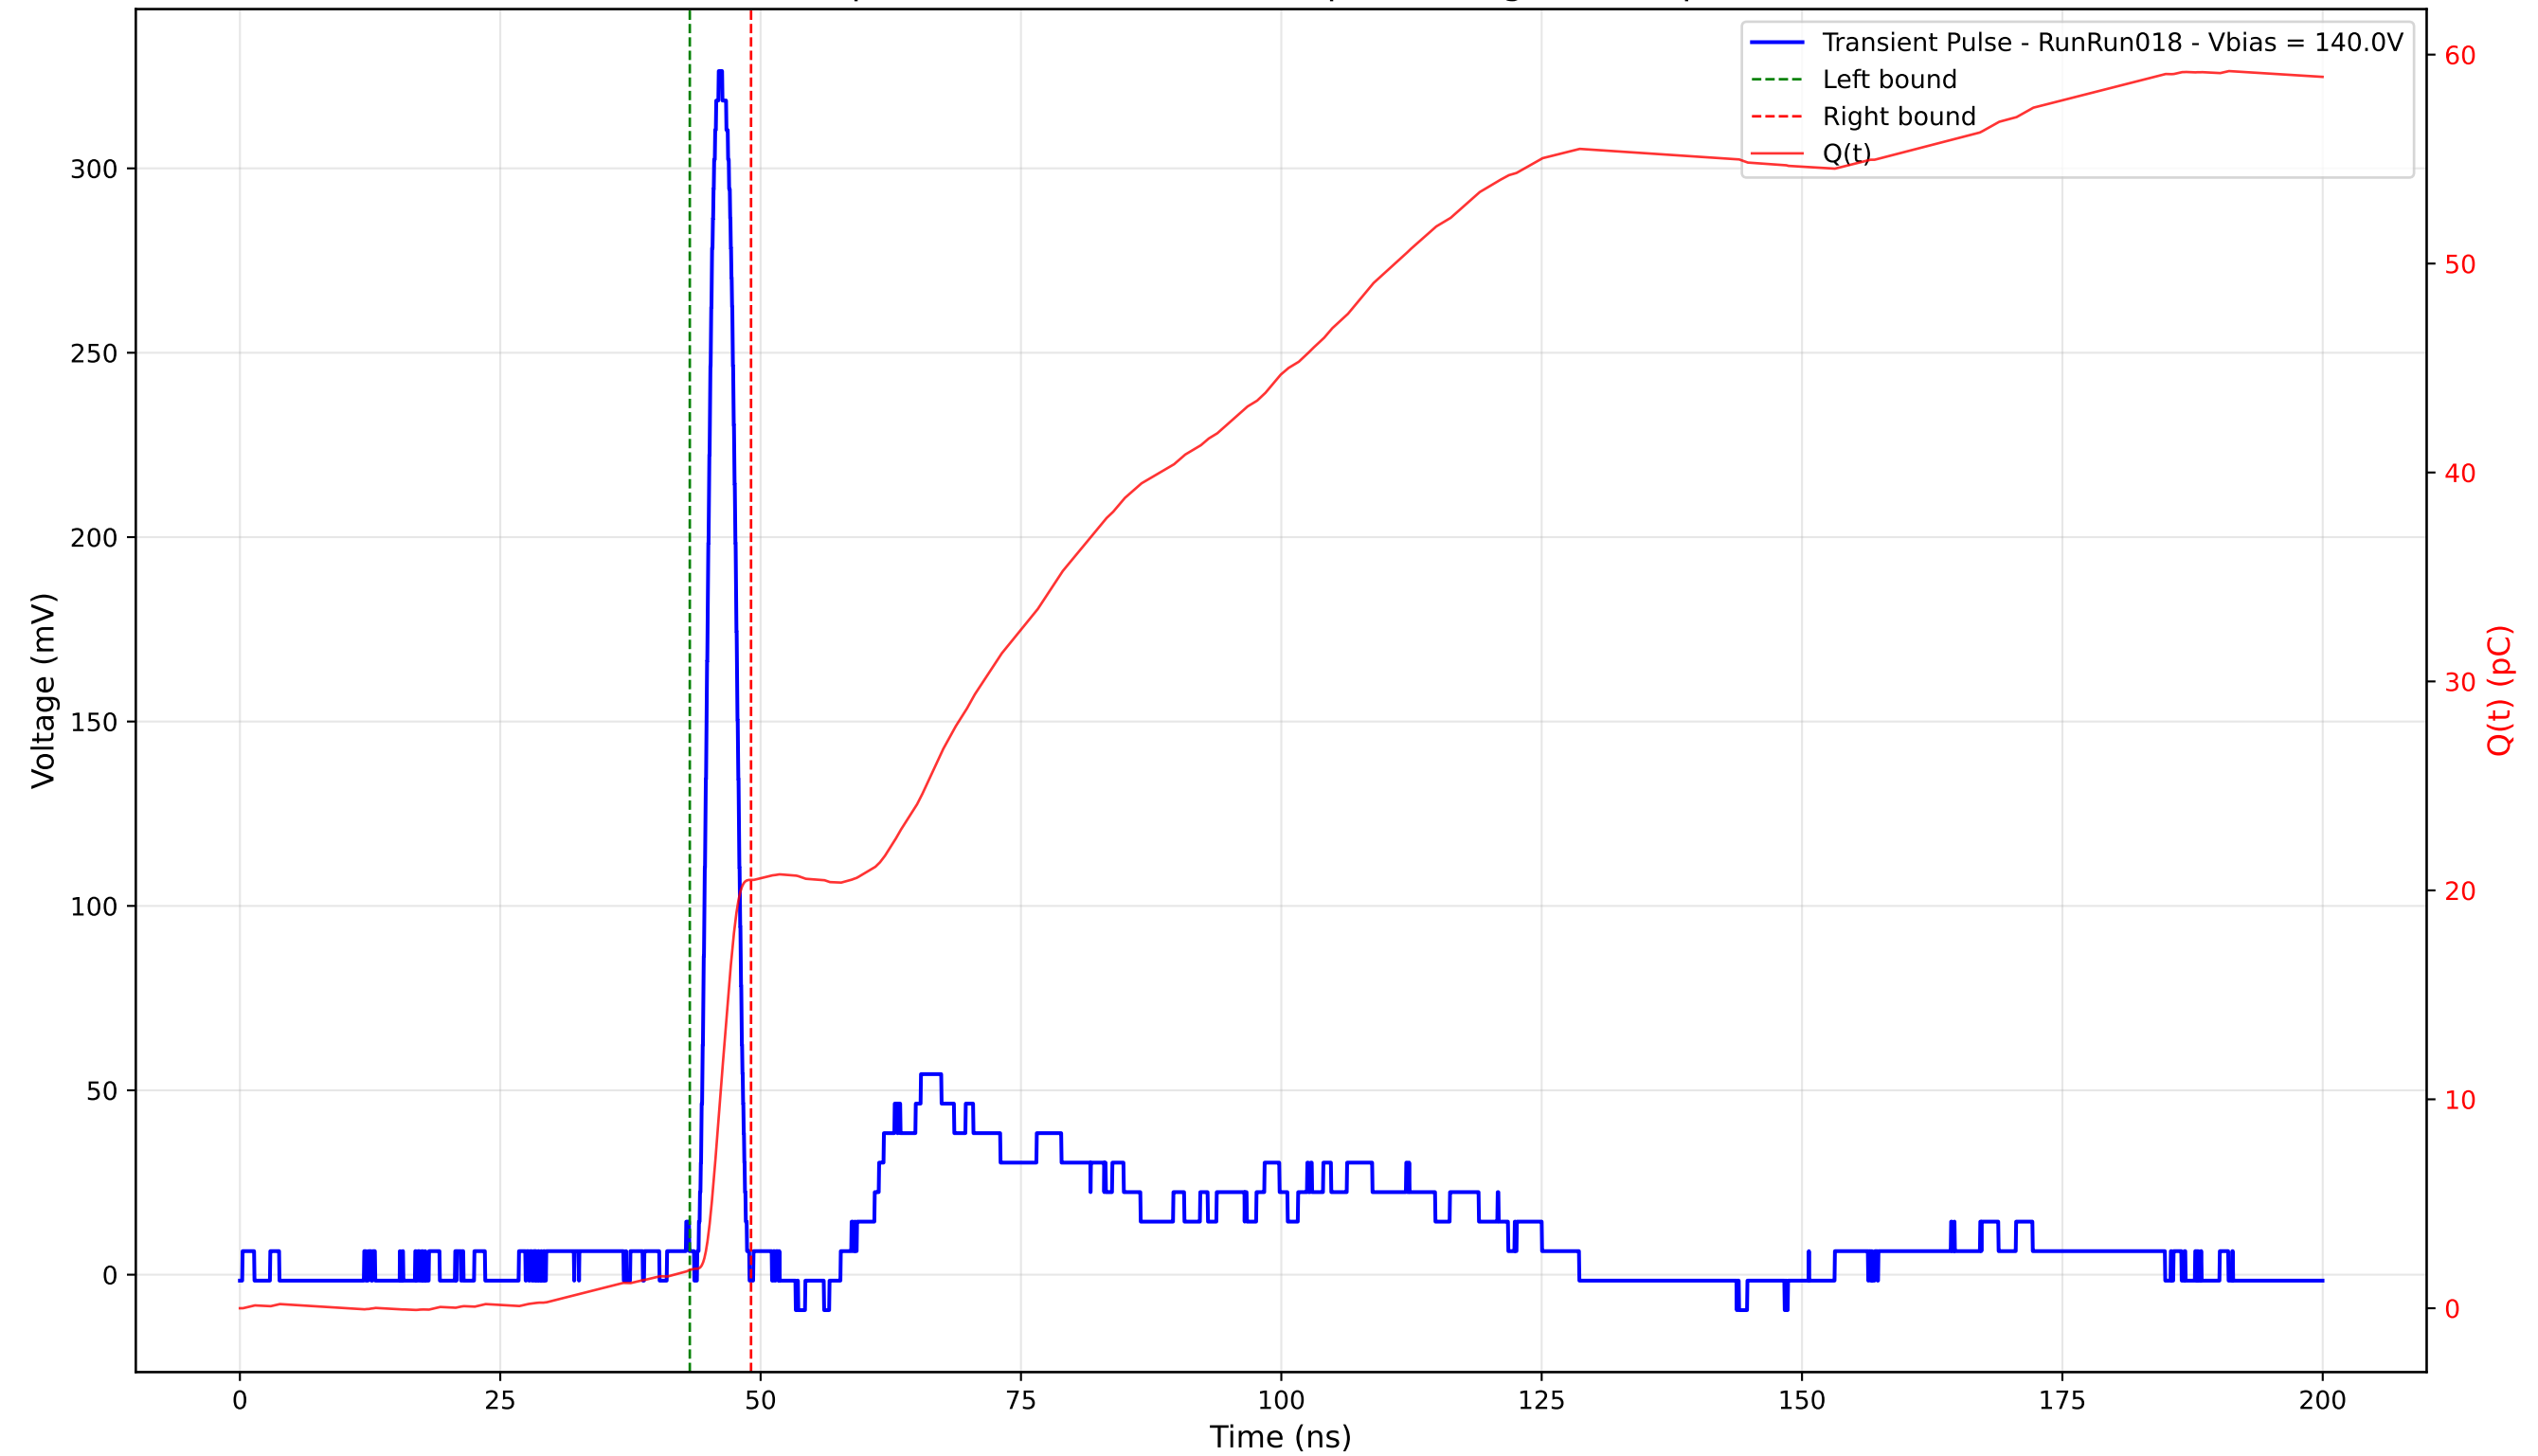


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 18.11 pC - Rise Time: 1.23 ns

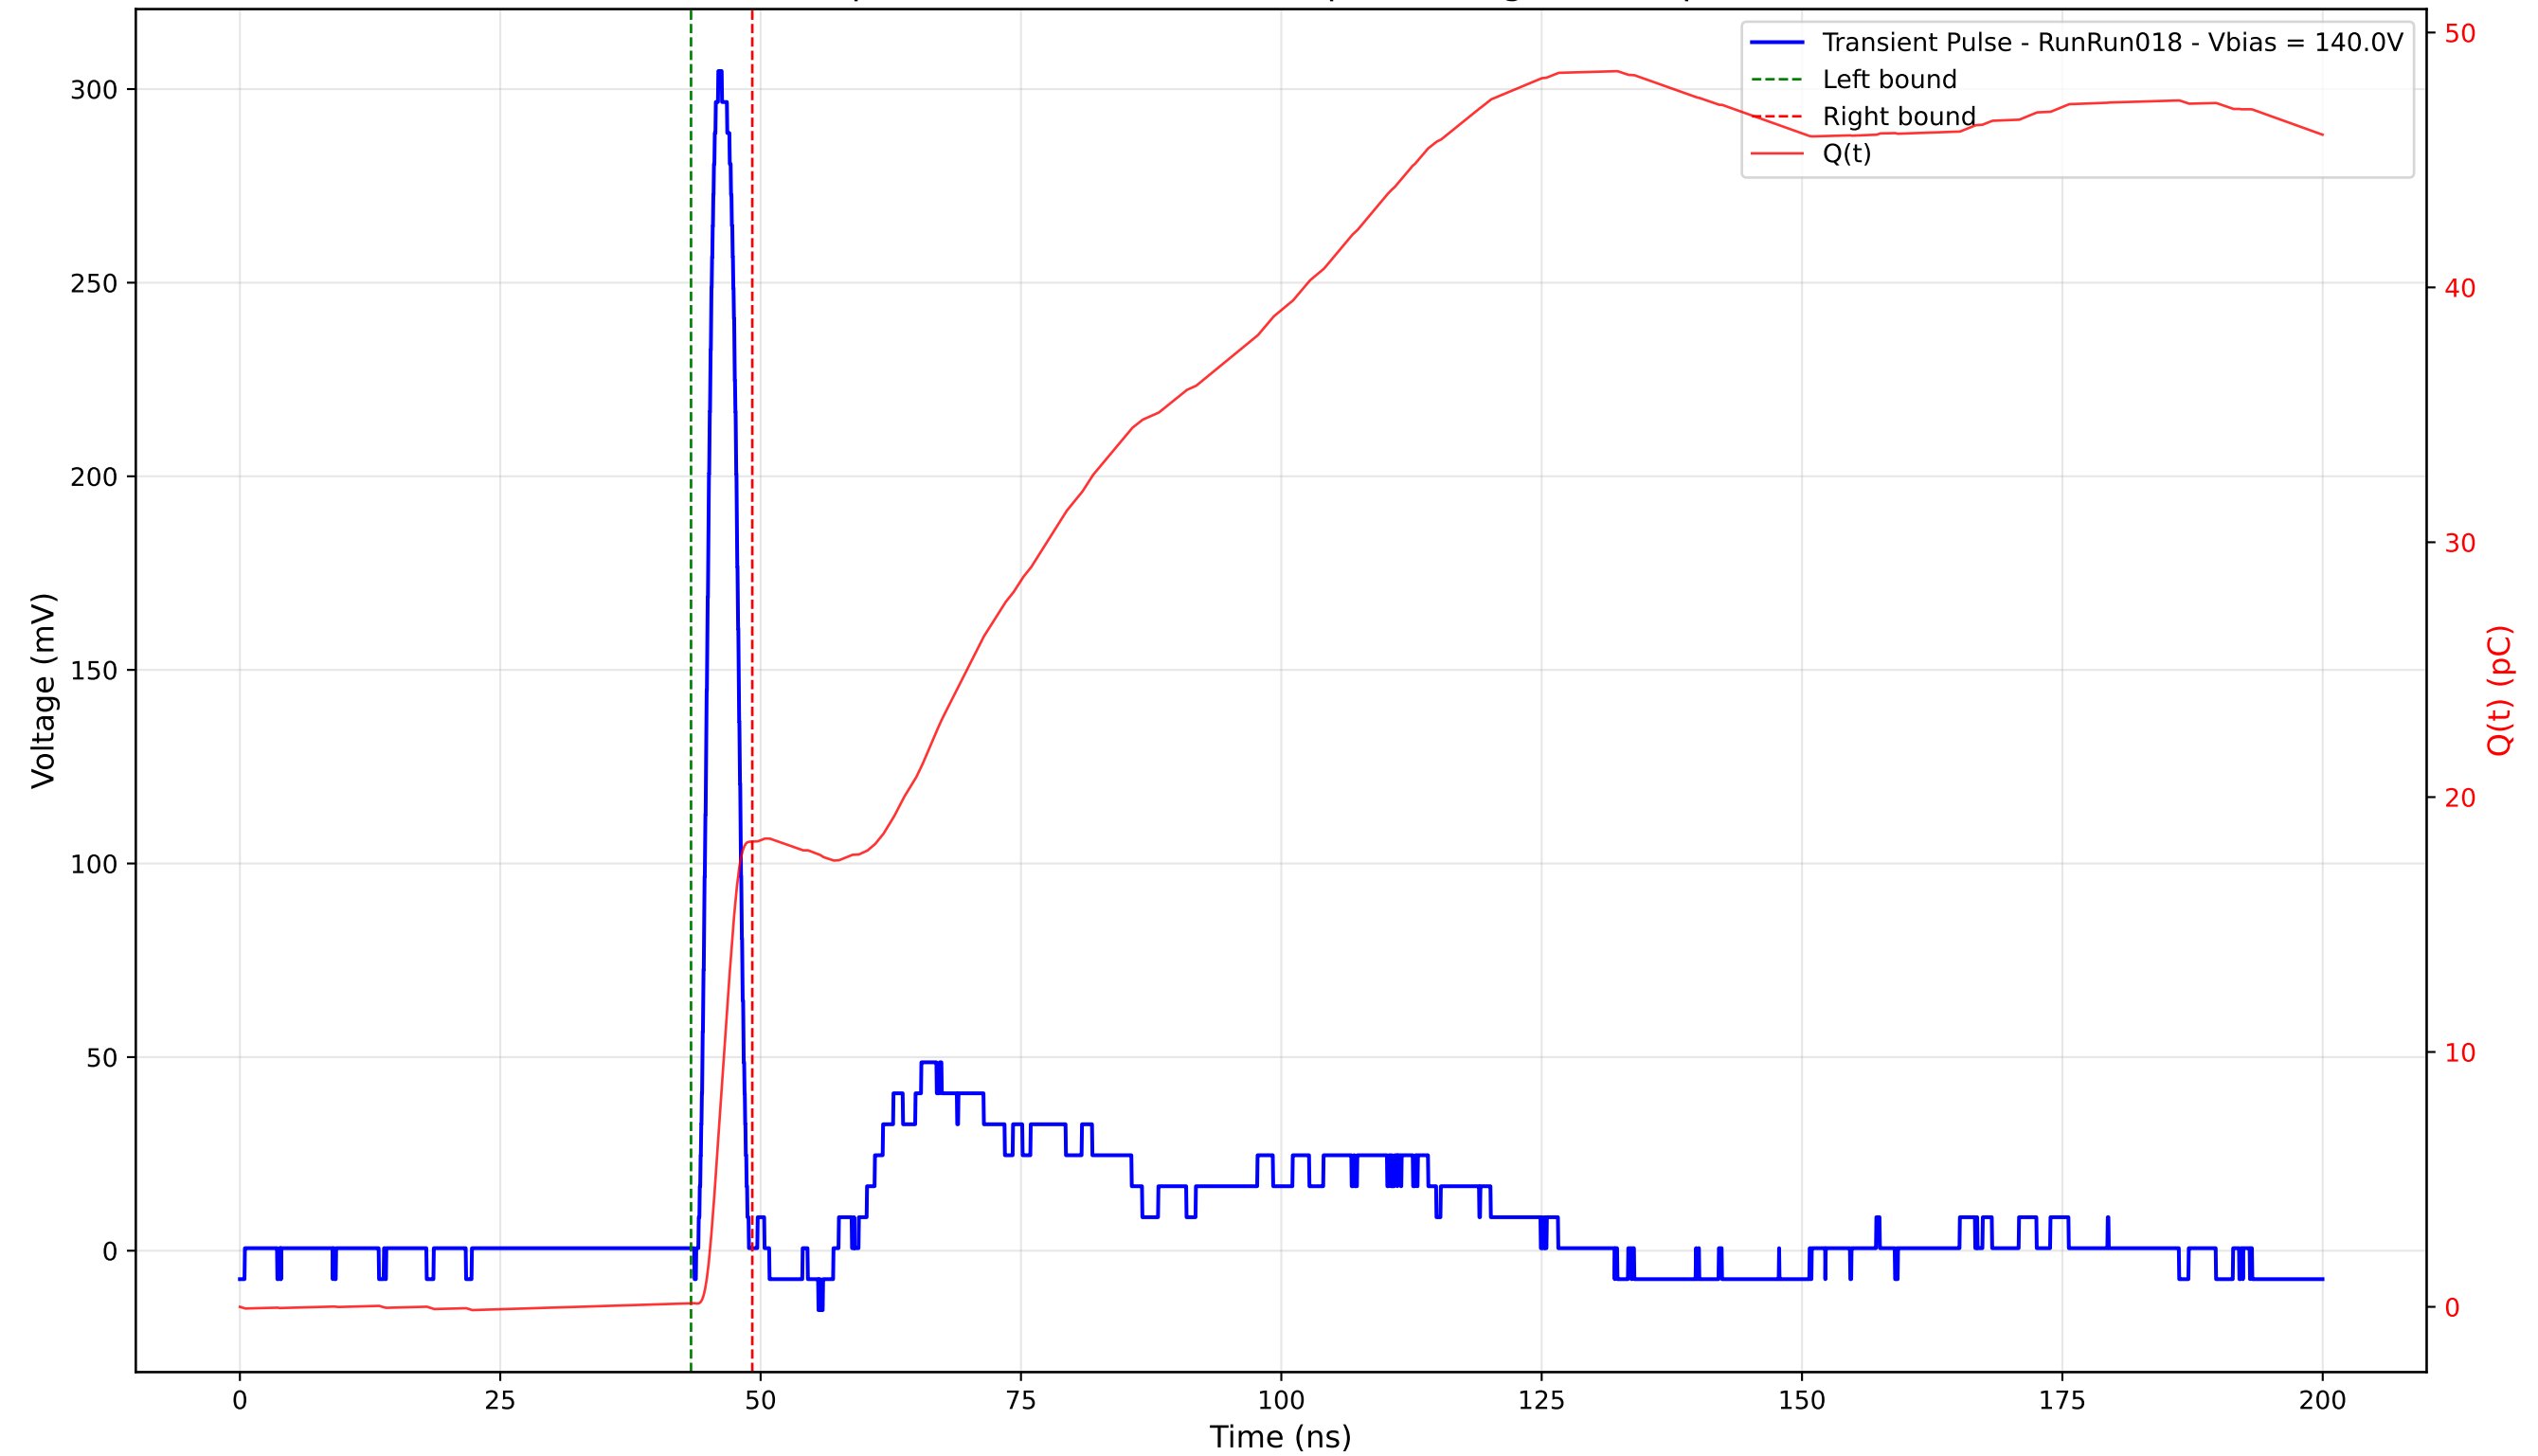


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 18.06 pC - Rise Time: 1.15 ns

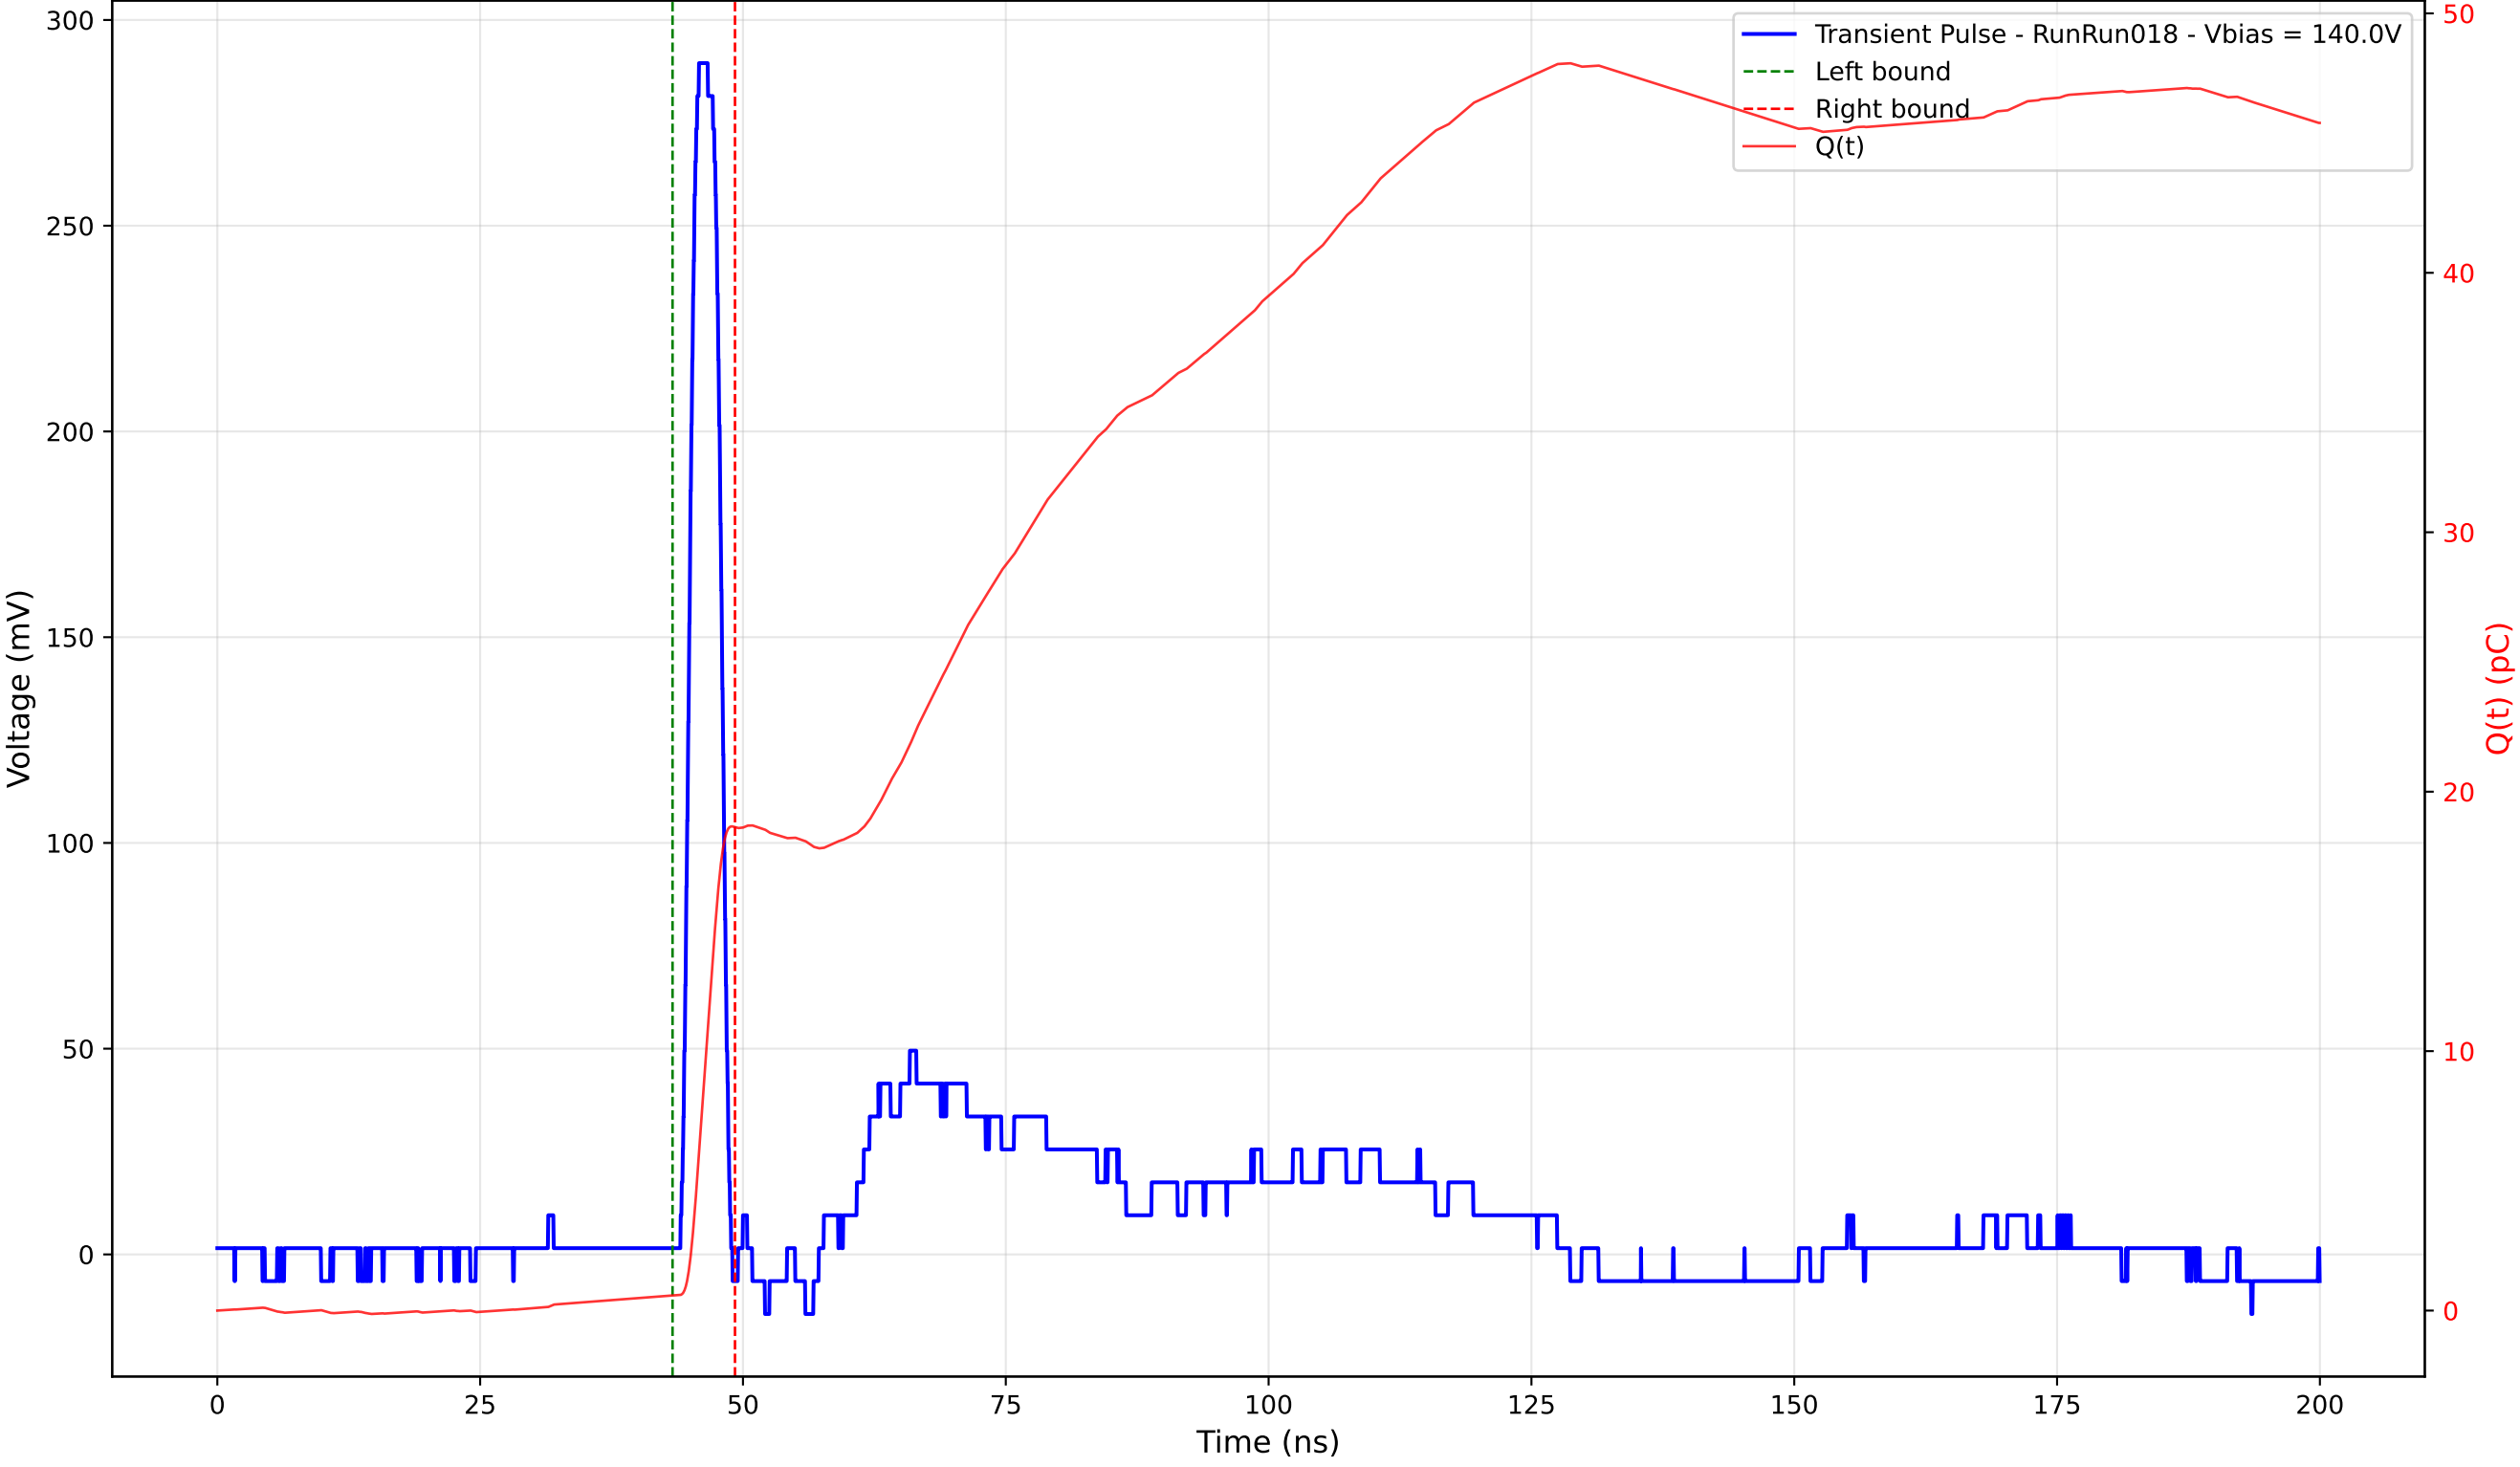


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 17.70 pC - Rise Time: 1.16 ns

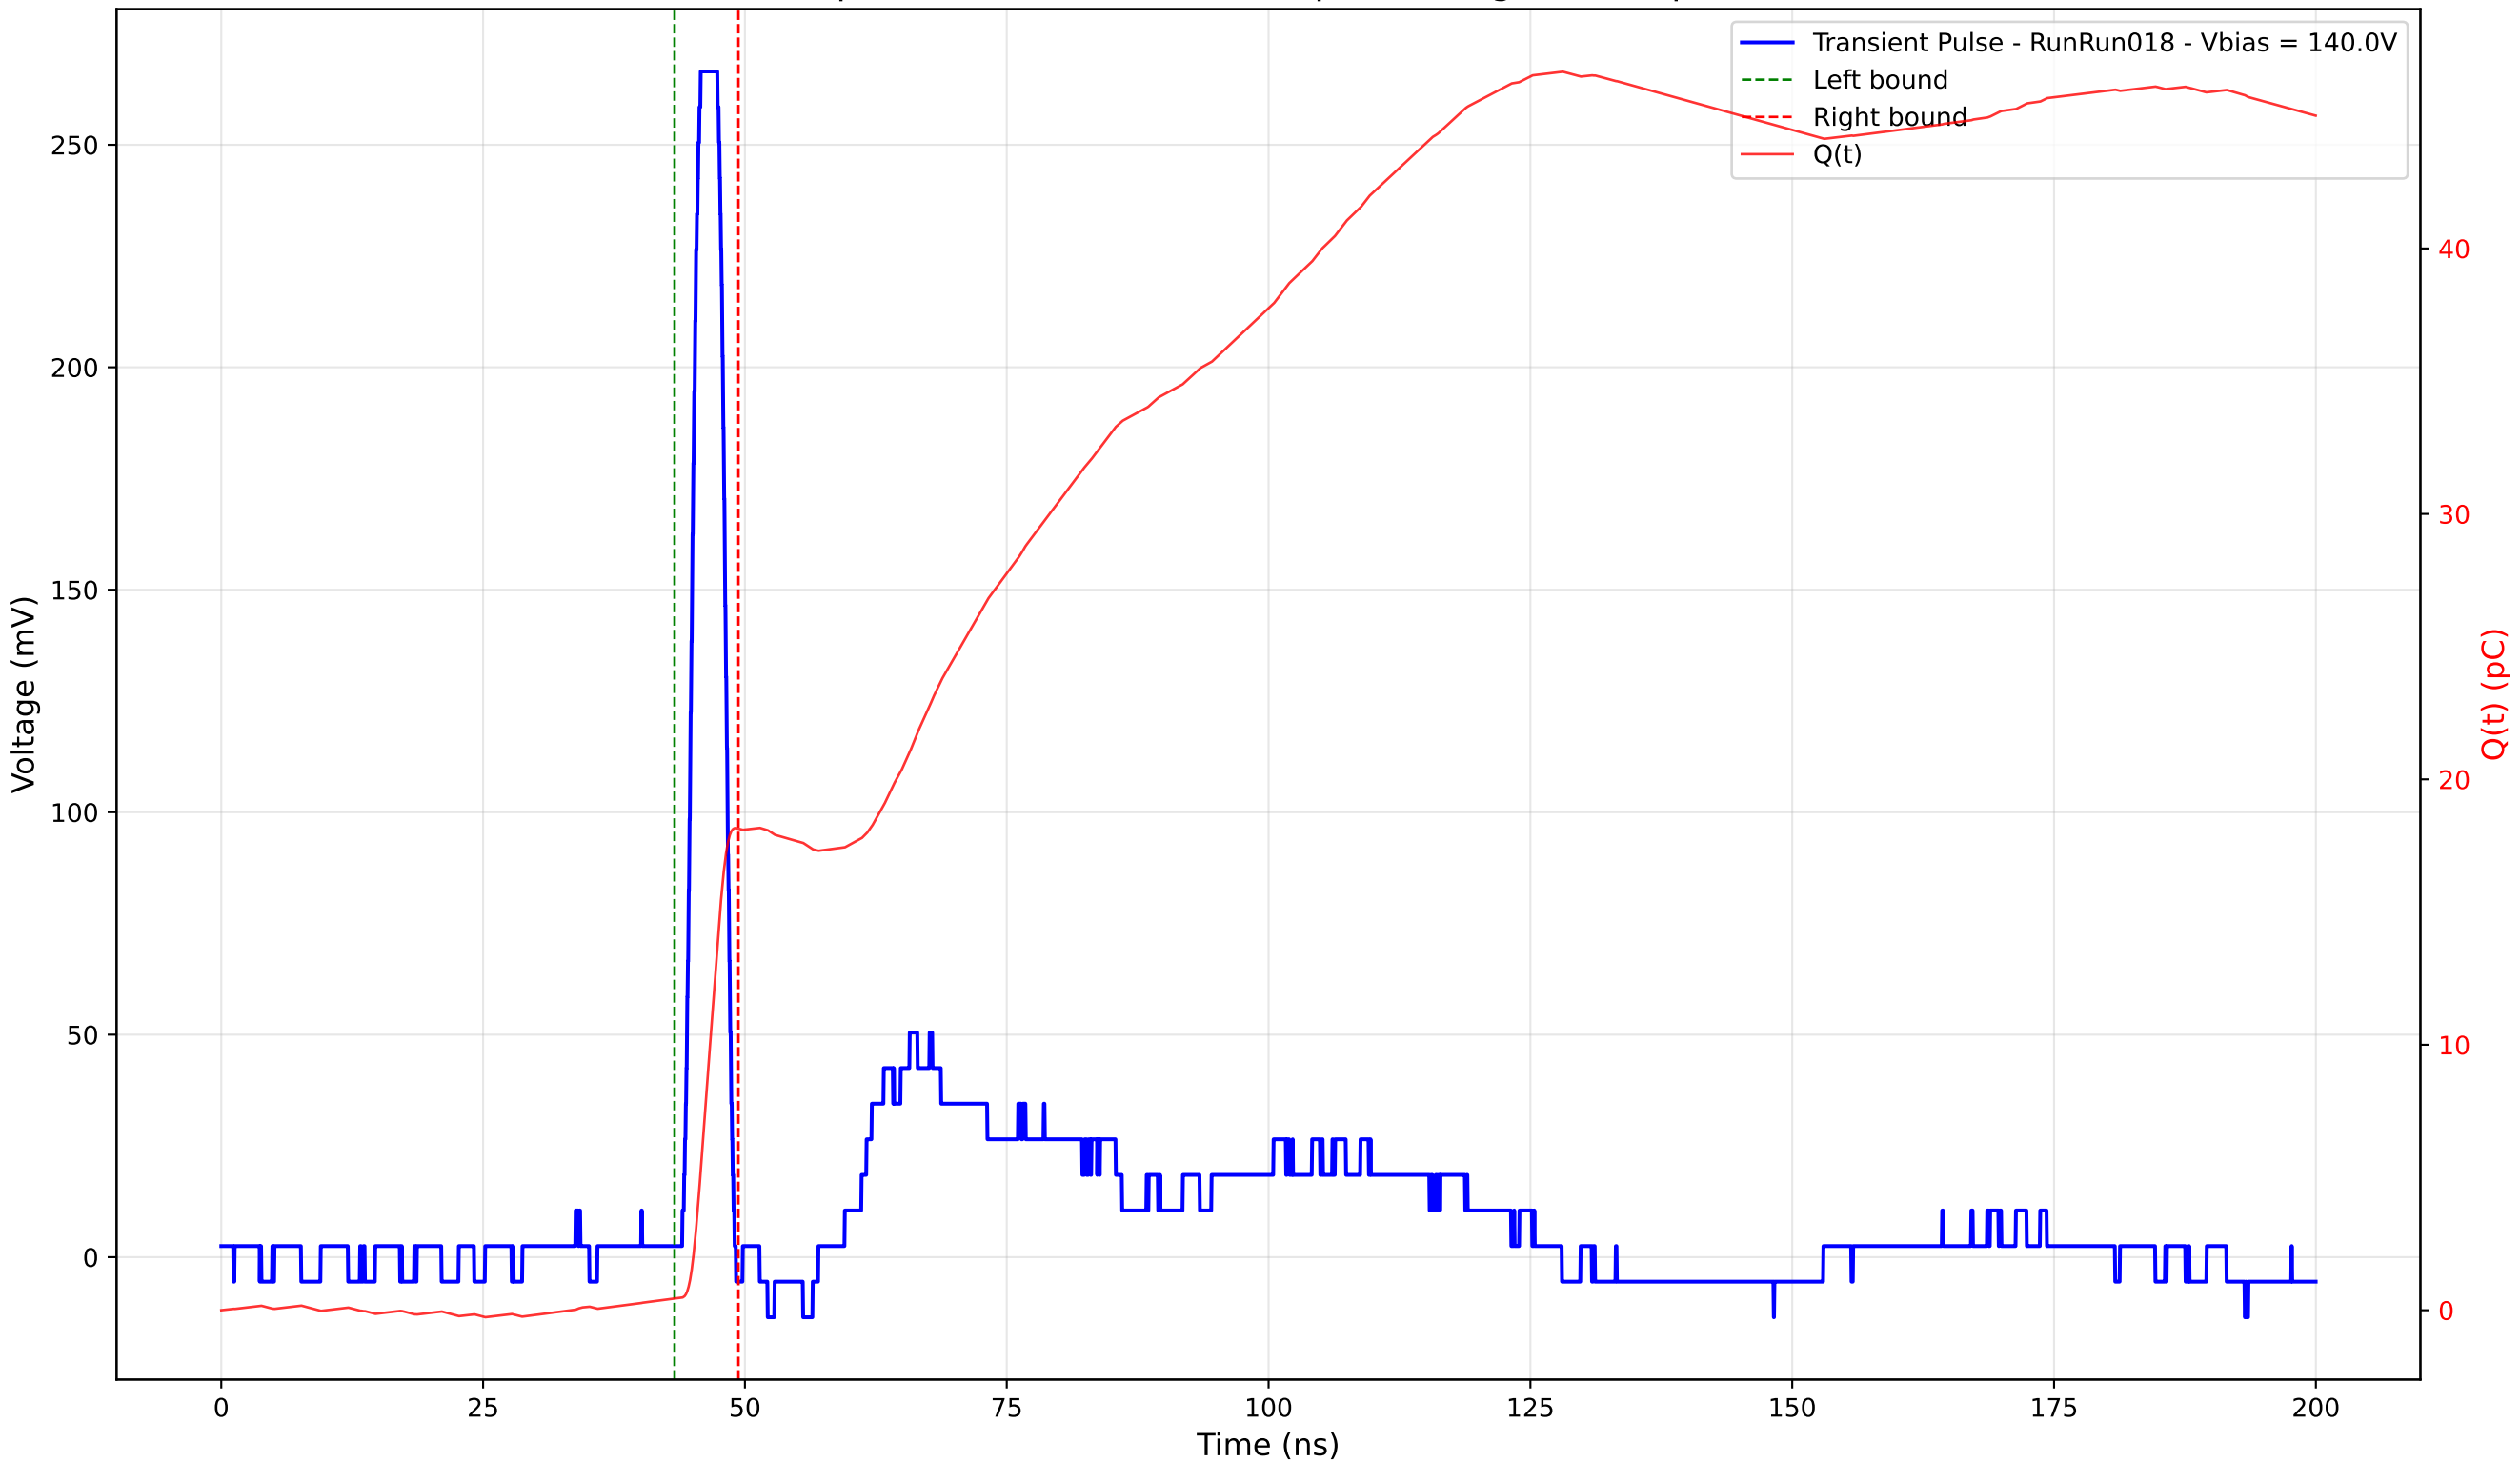


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 17.91 pC - Rise Time: 1.21 ns

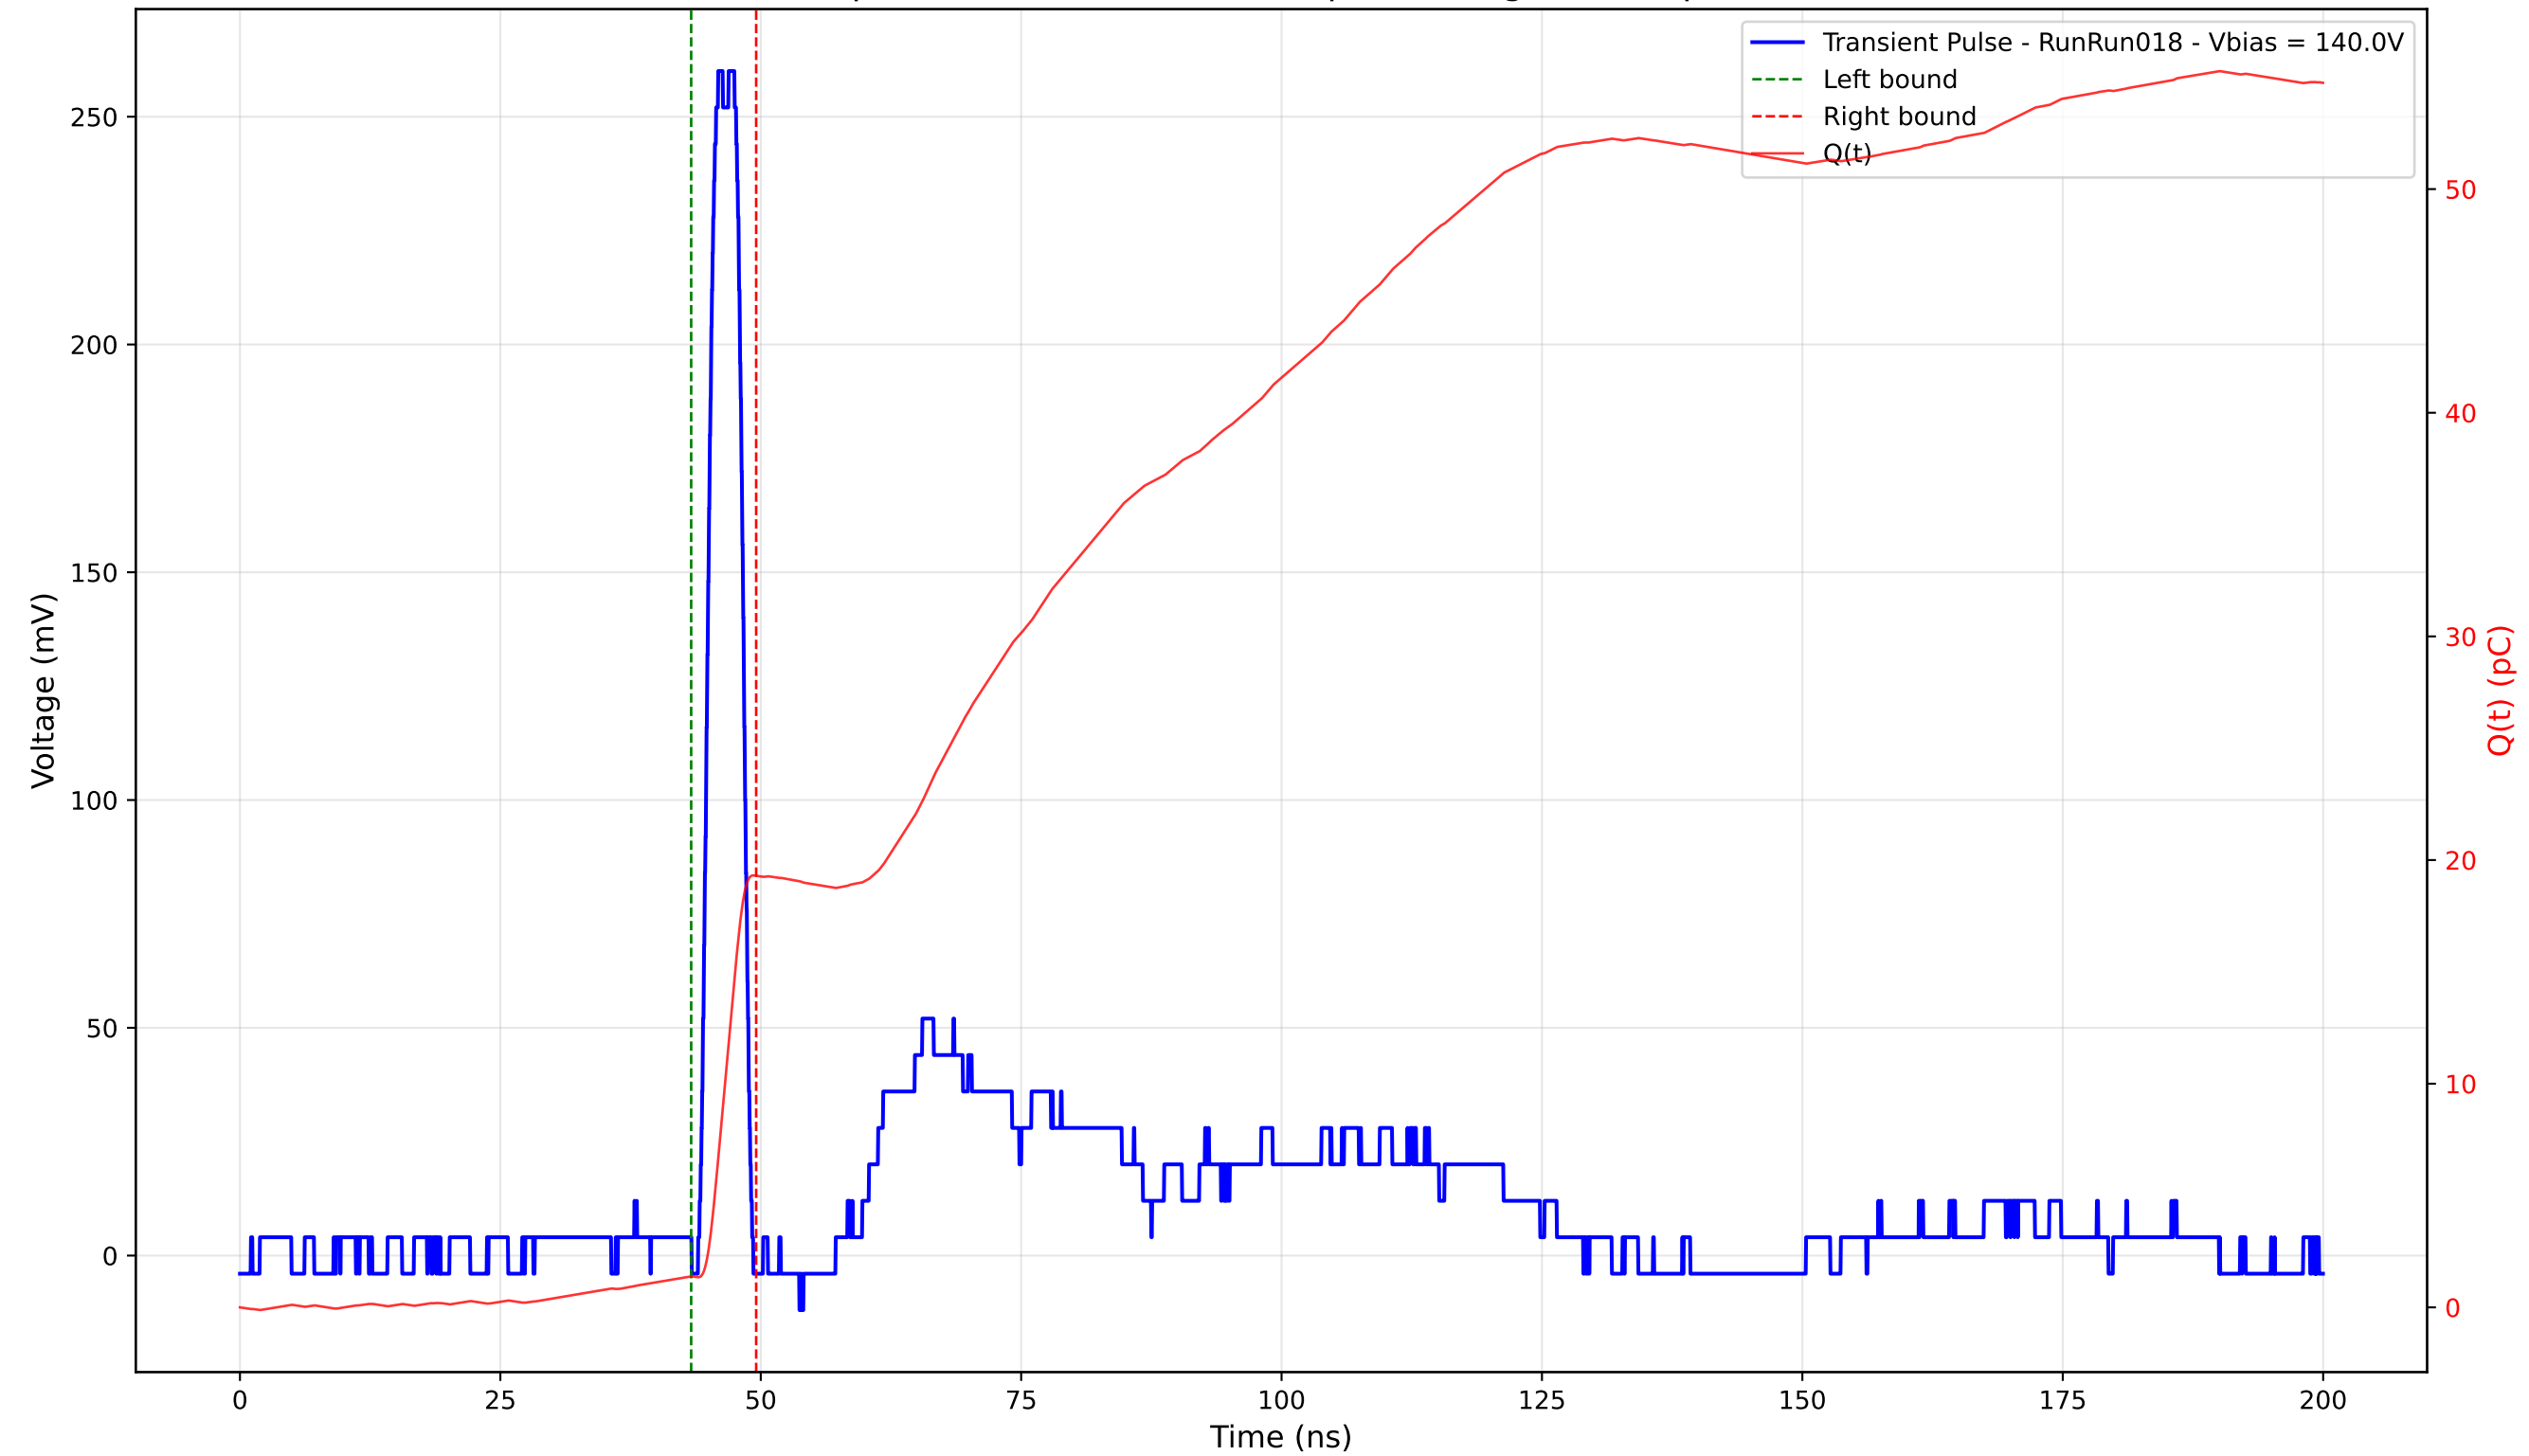


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 17.09 pC - Rise Time: 1.48 ns

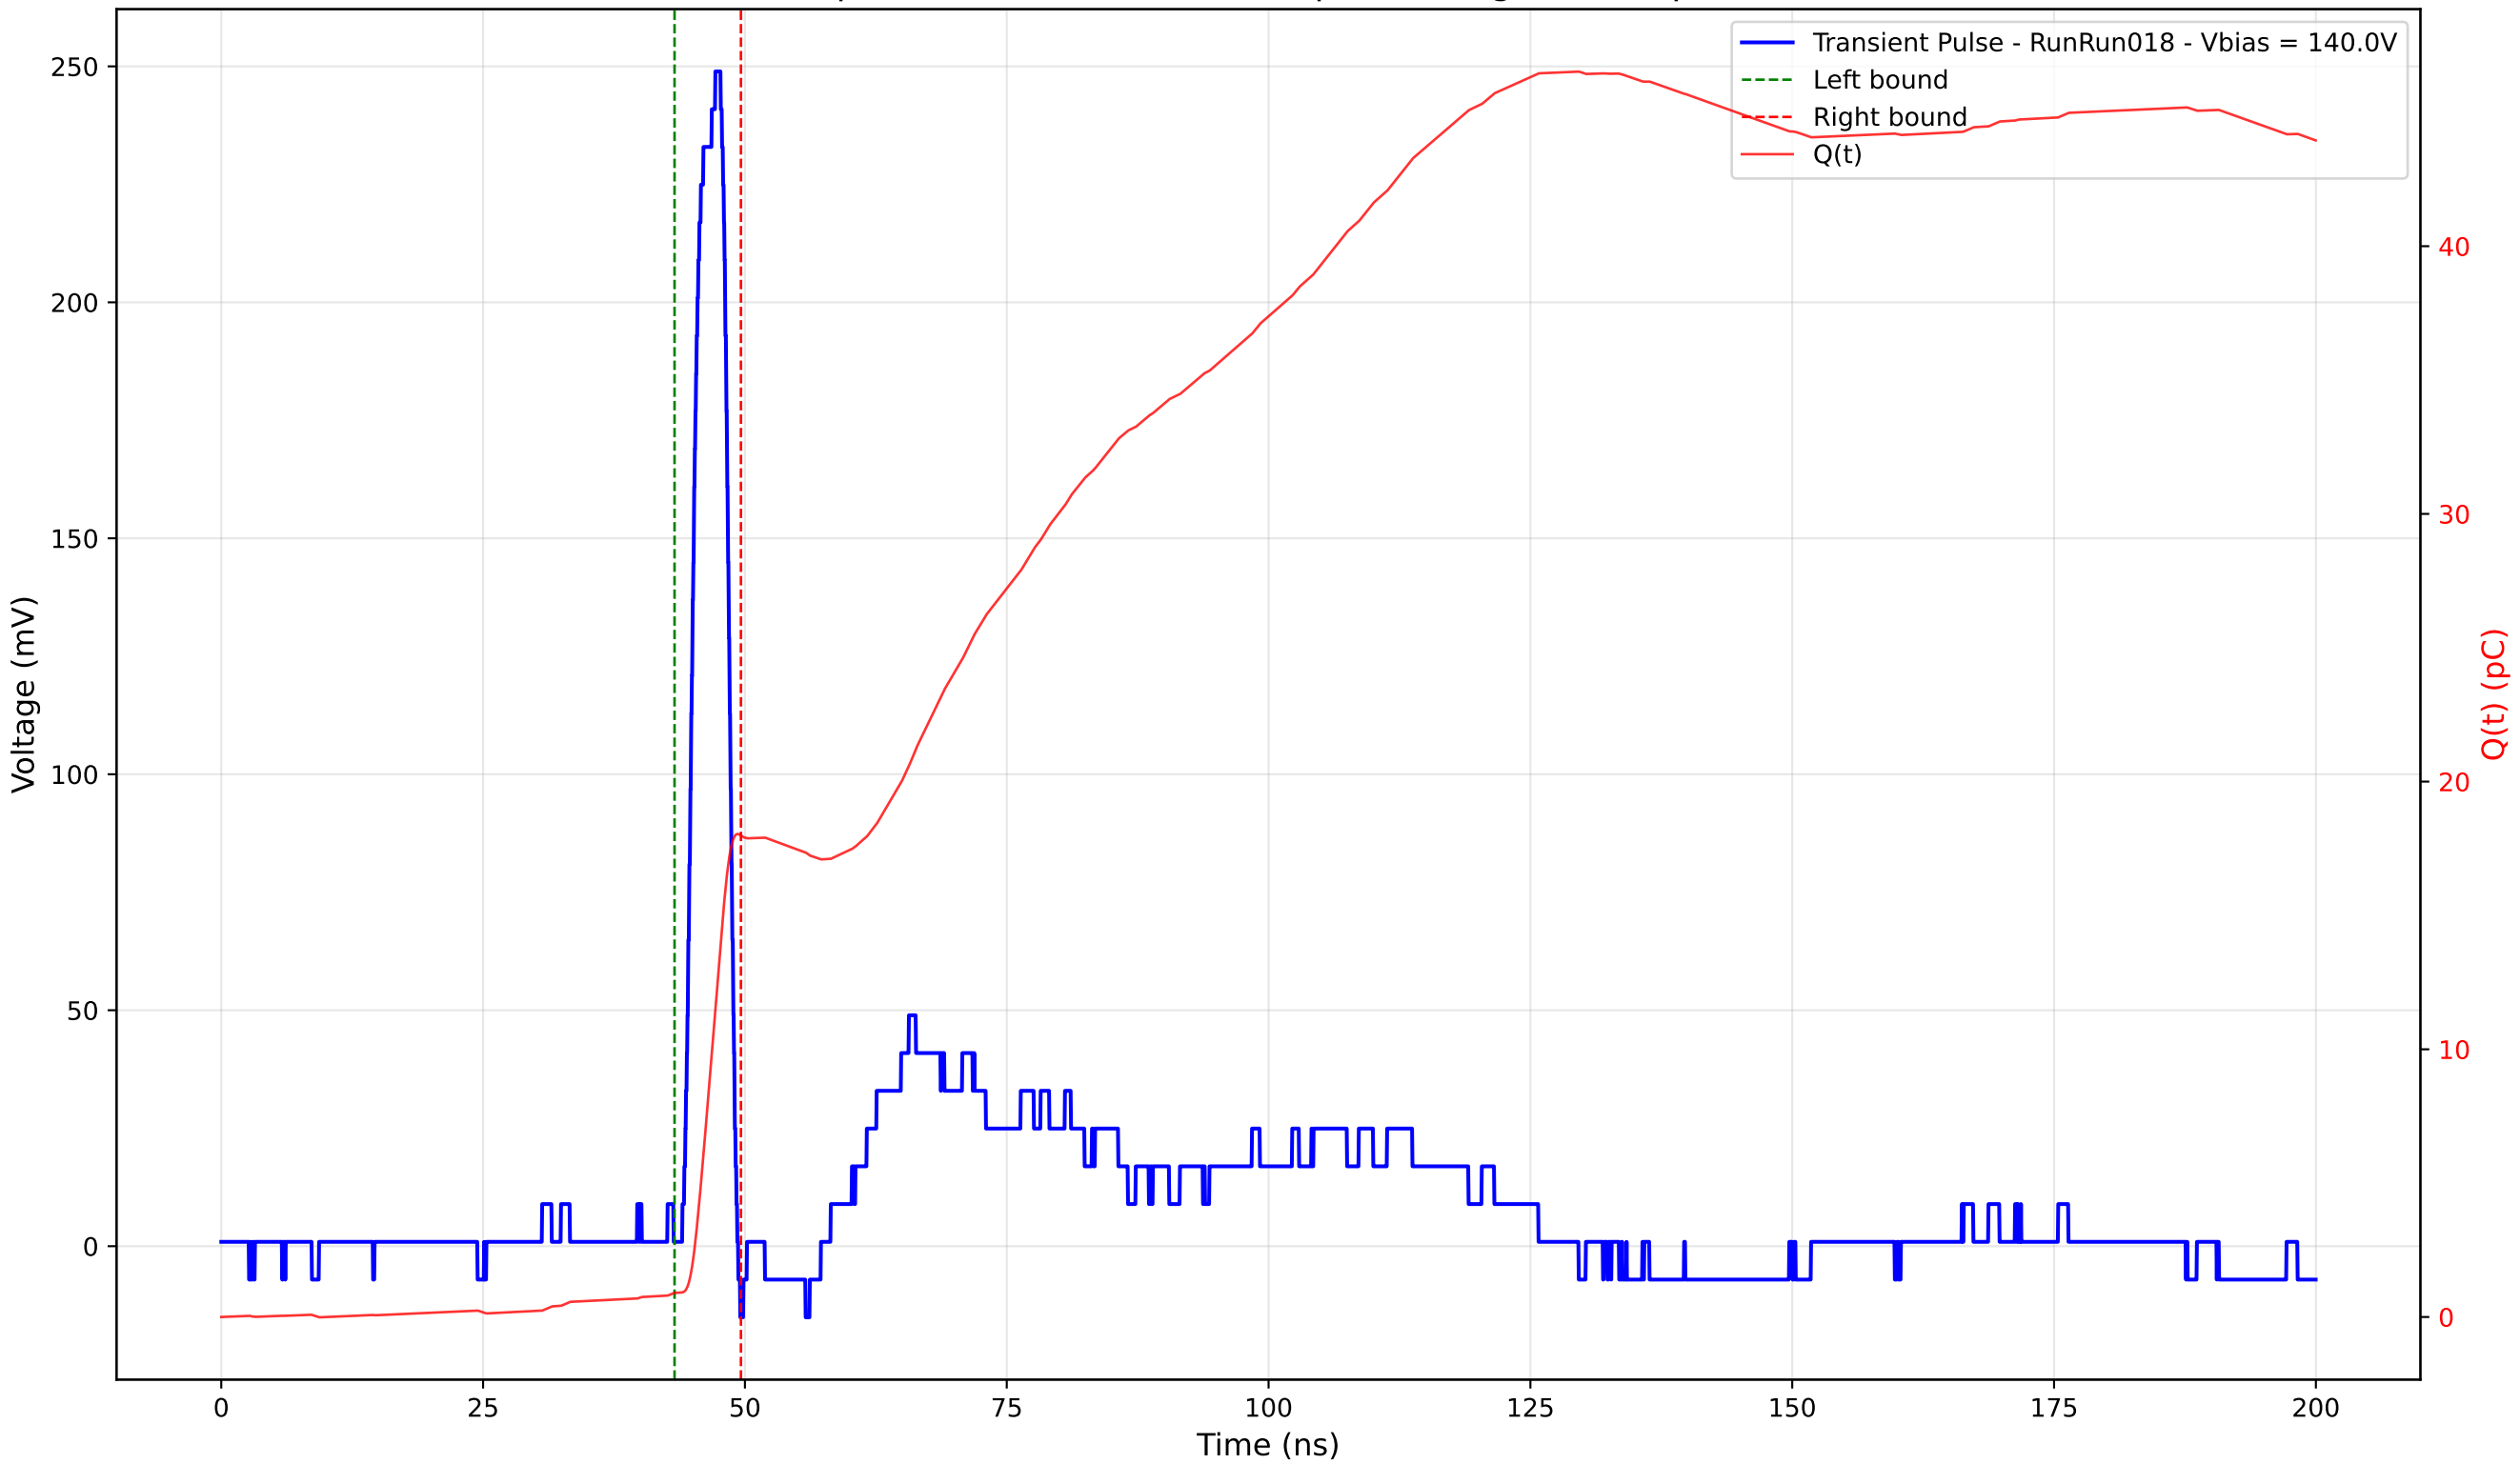


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 16.83 pC - Rise Time: 2.45 ns

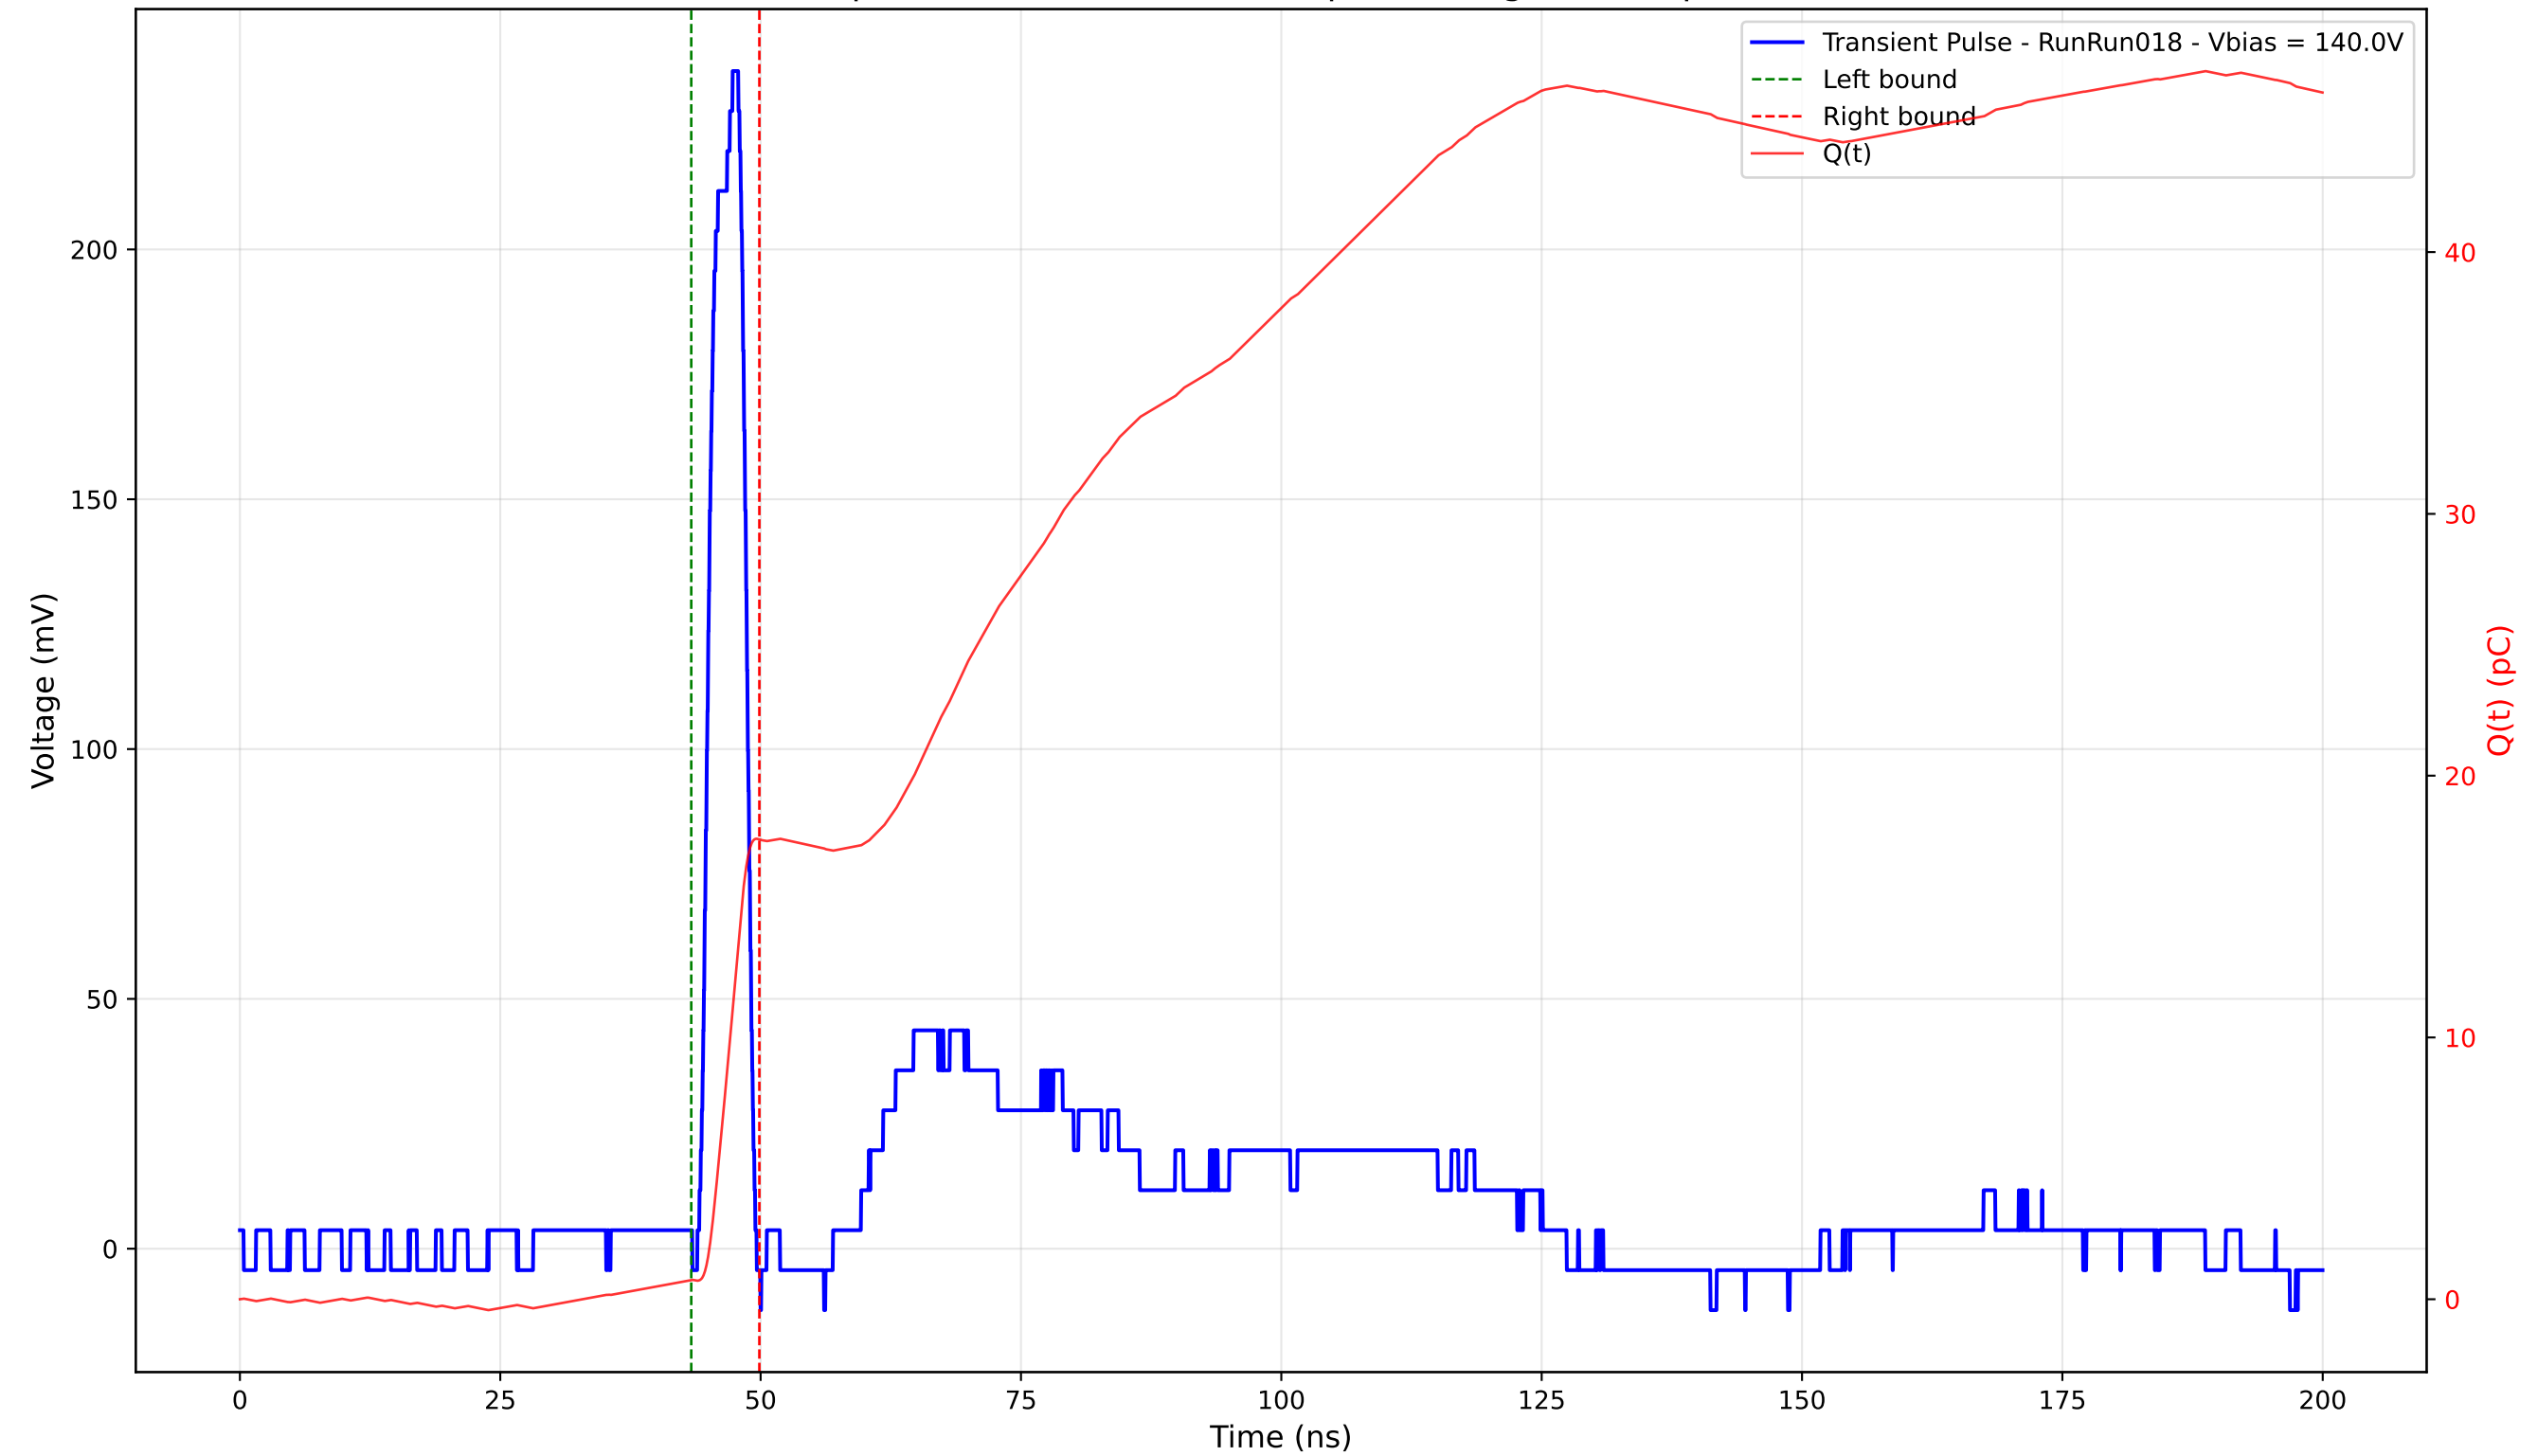


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 16.34 pC - Rise Time: 2.48 ns

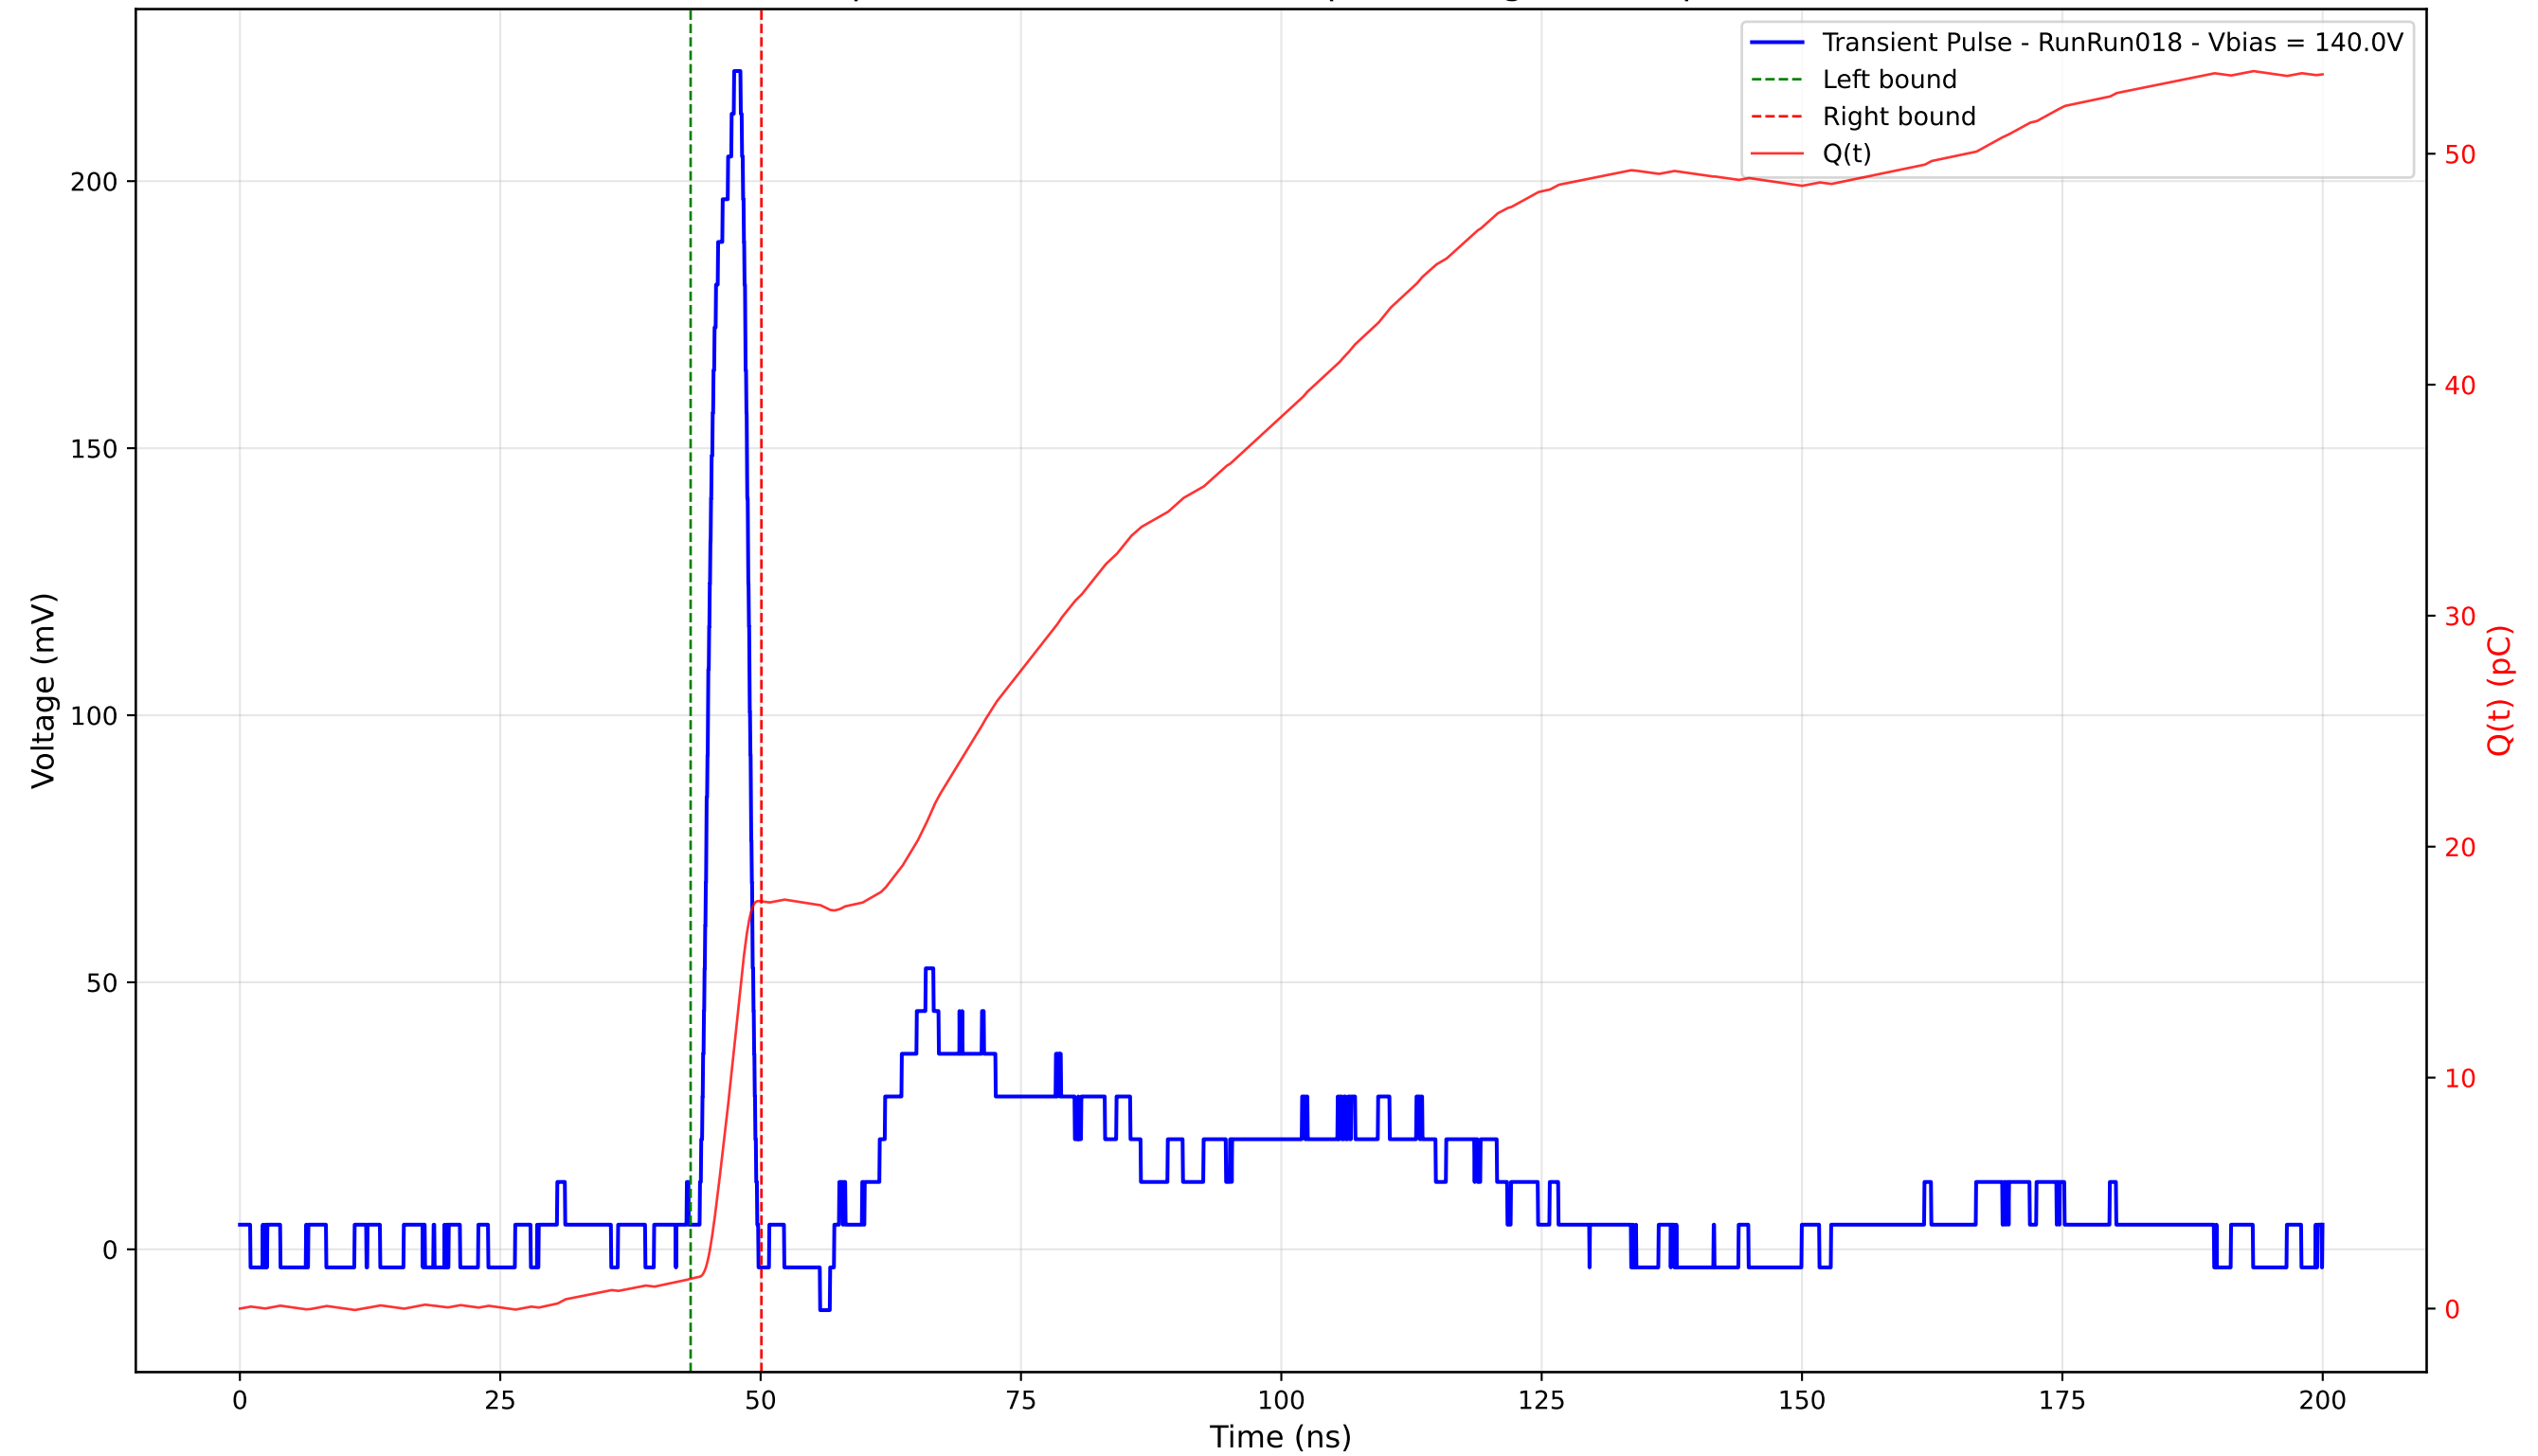


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 15.37 pC - Rise Time: 2.96 ns

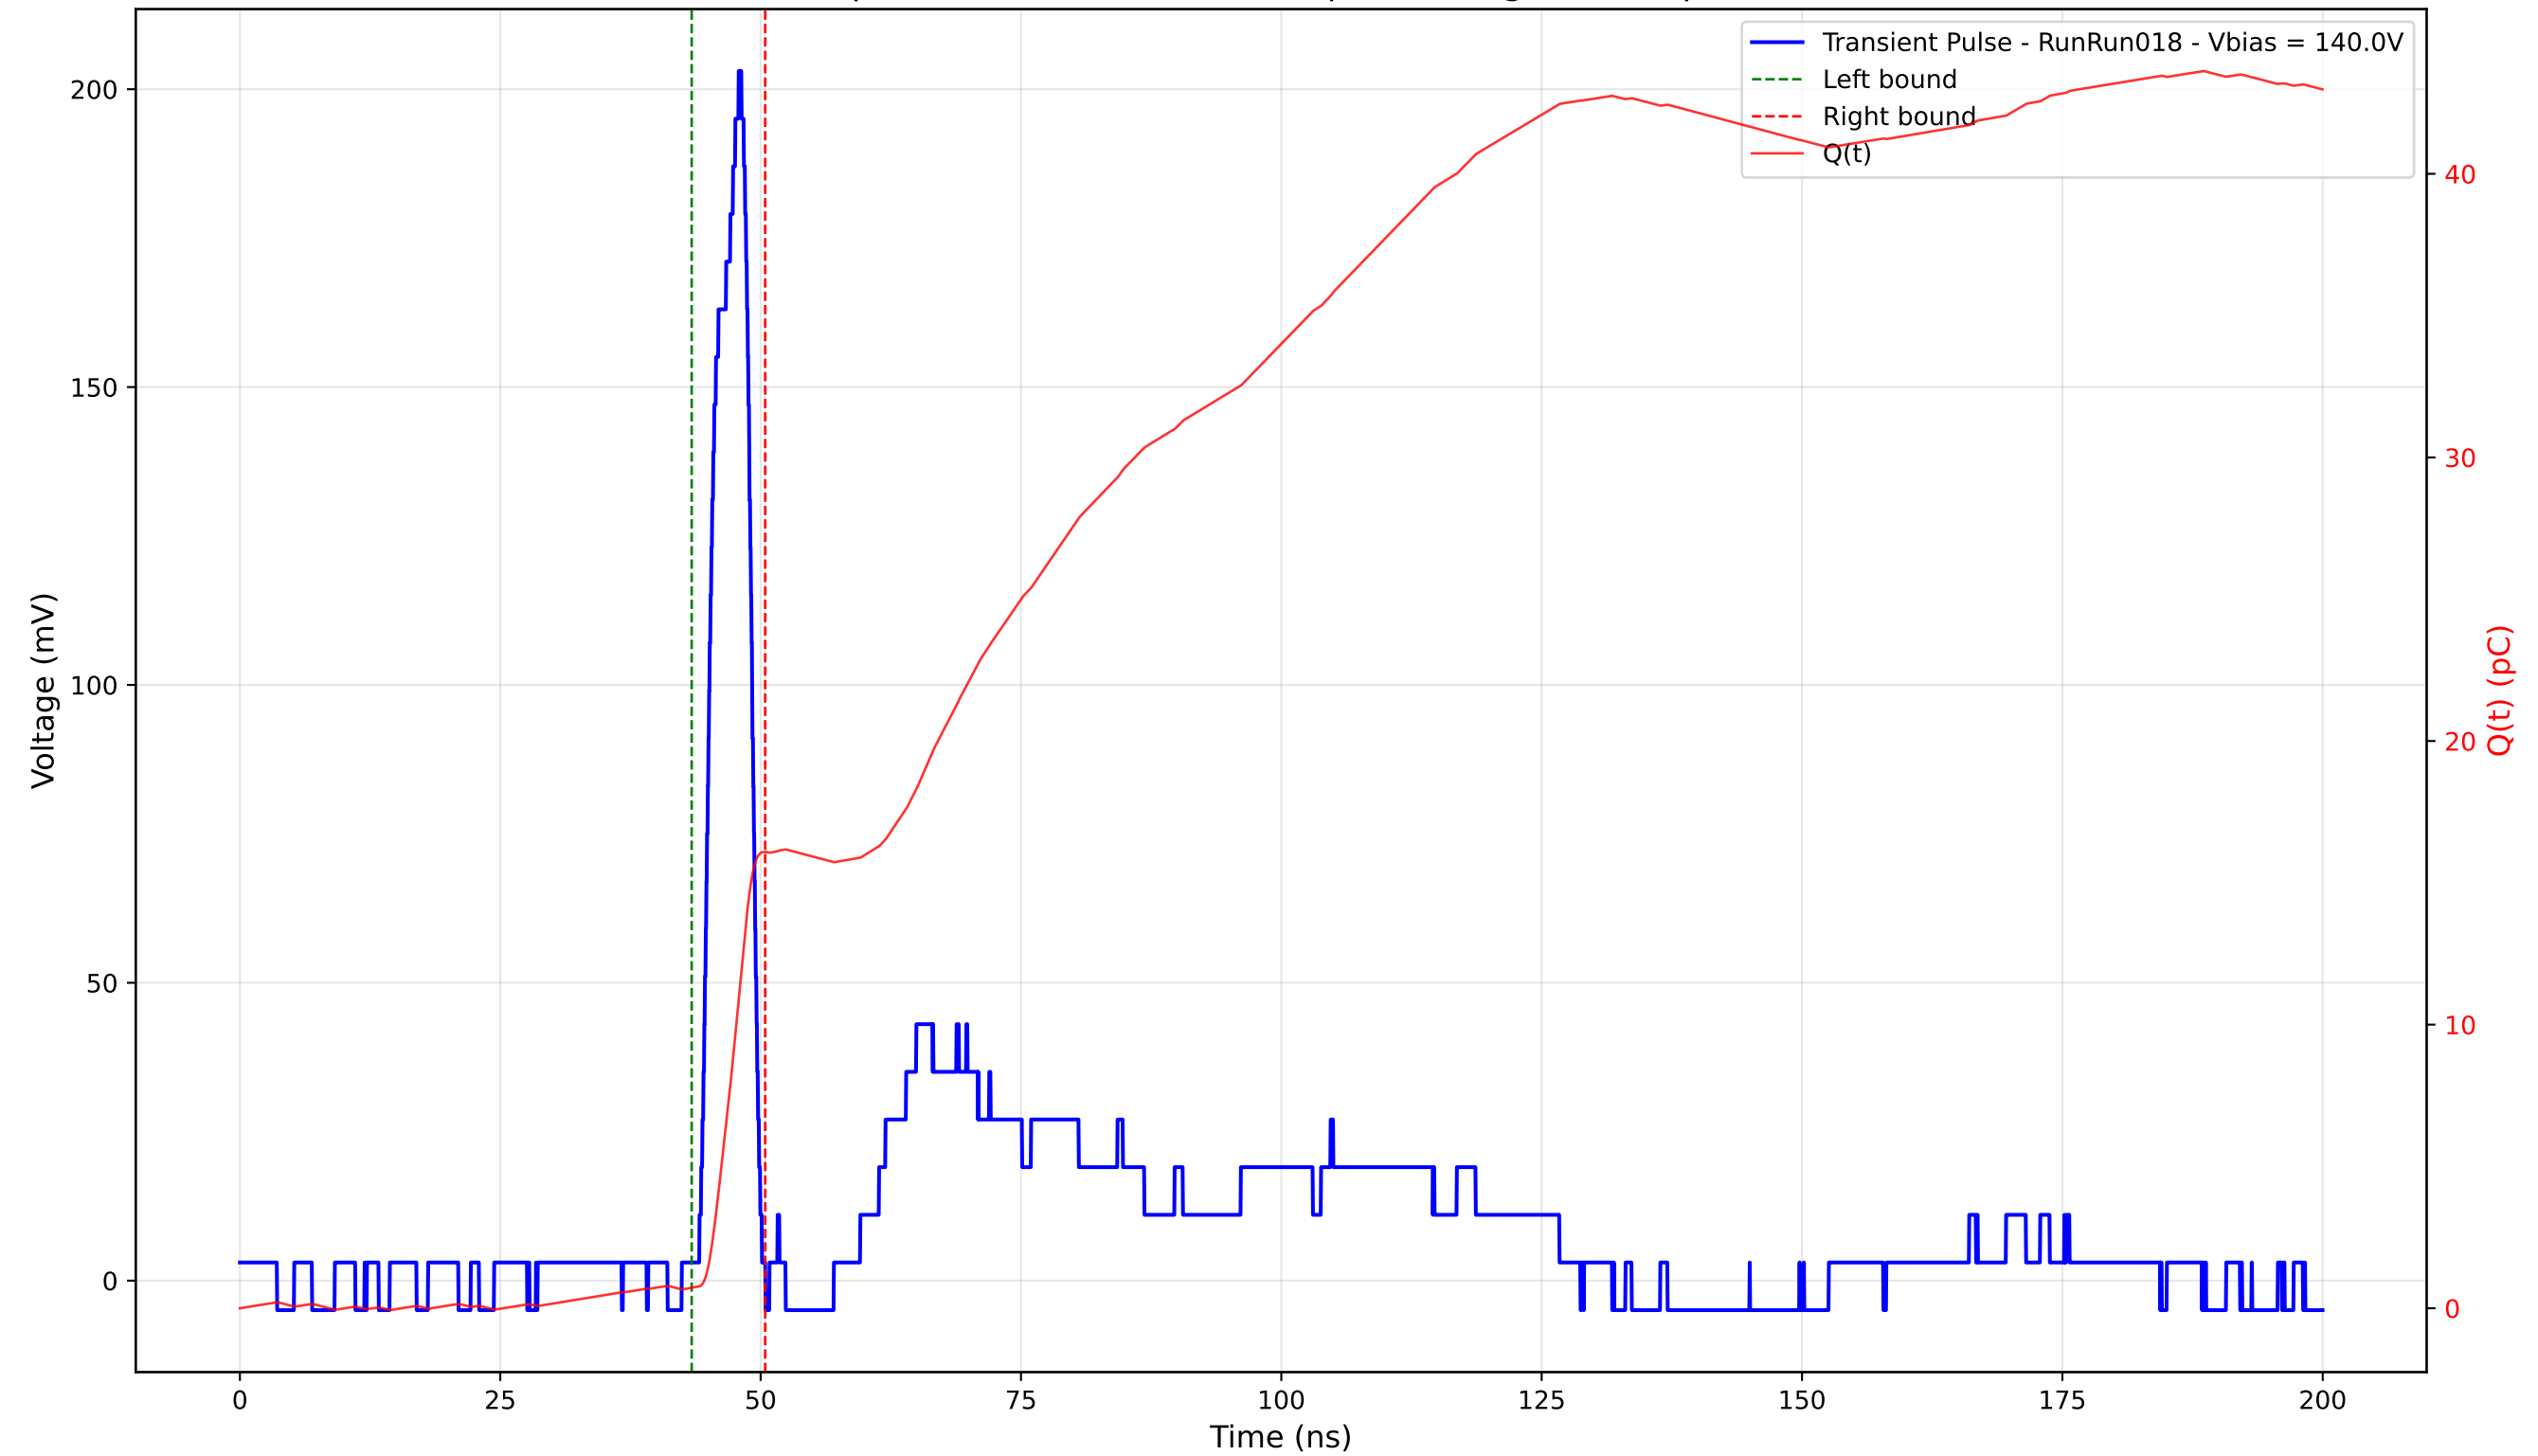


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 14.40 pC - Rise Time: 3.20 ns

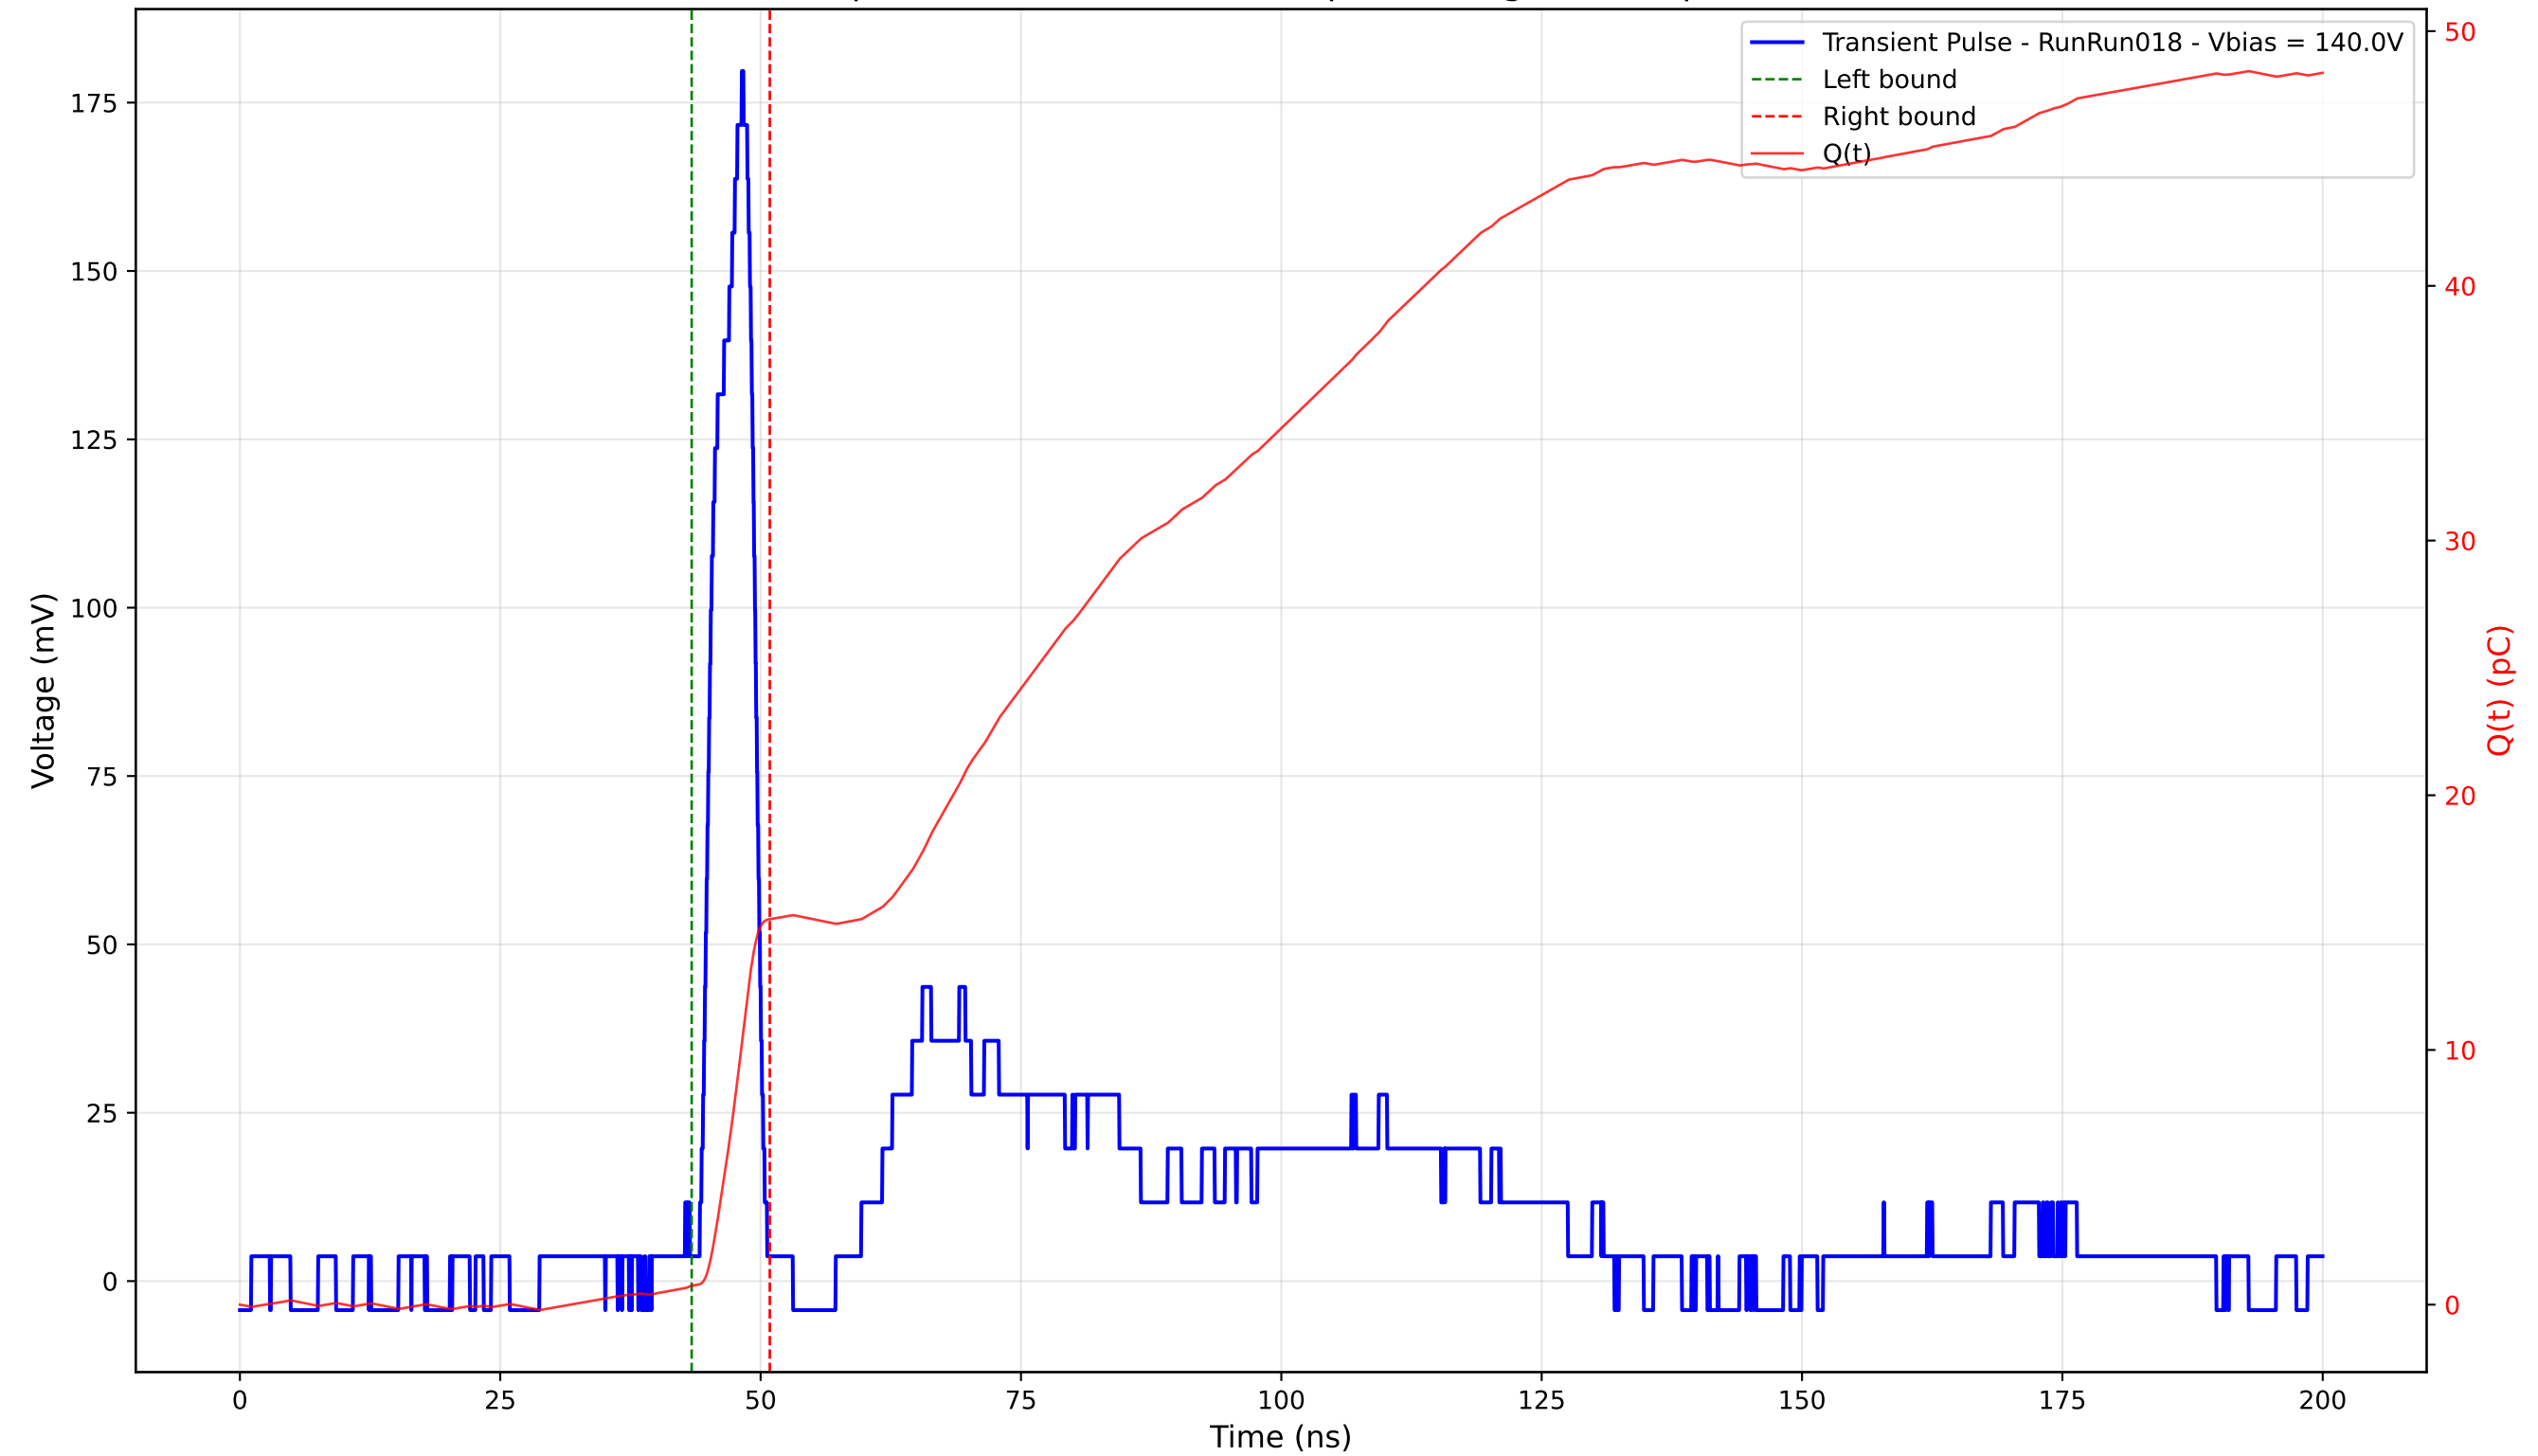


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 13.24 pC - Rise Time: 3.49 ns

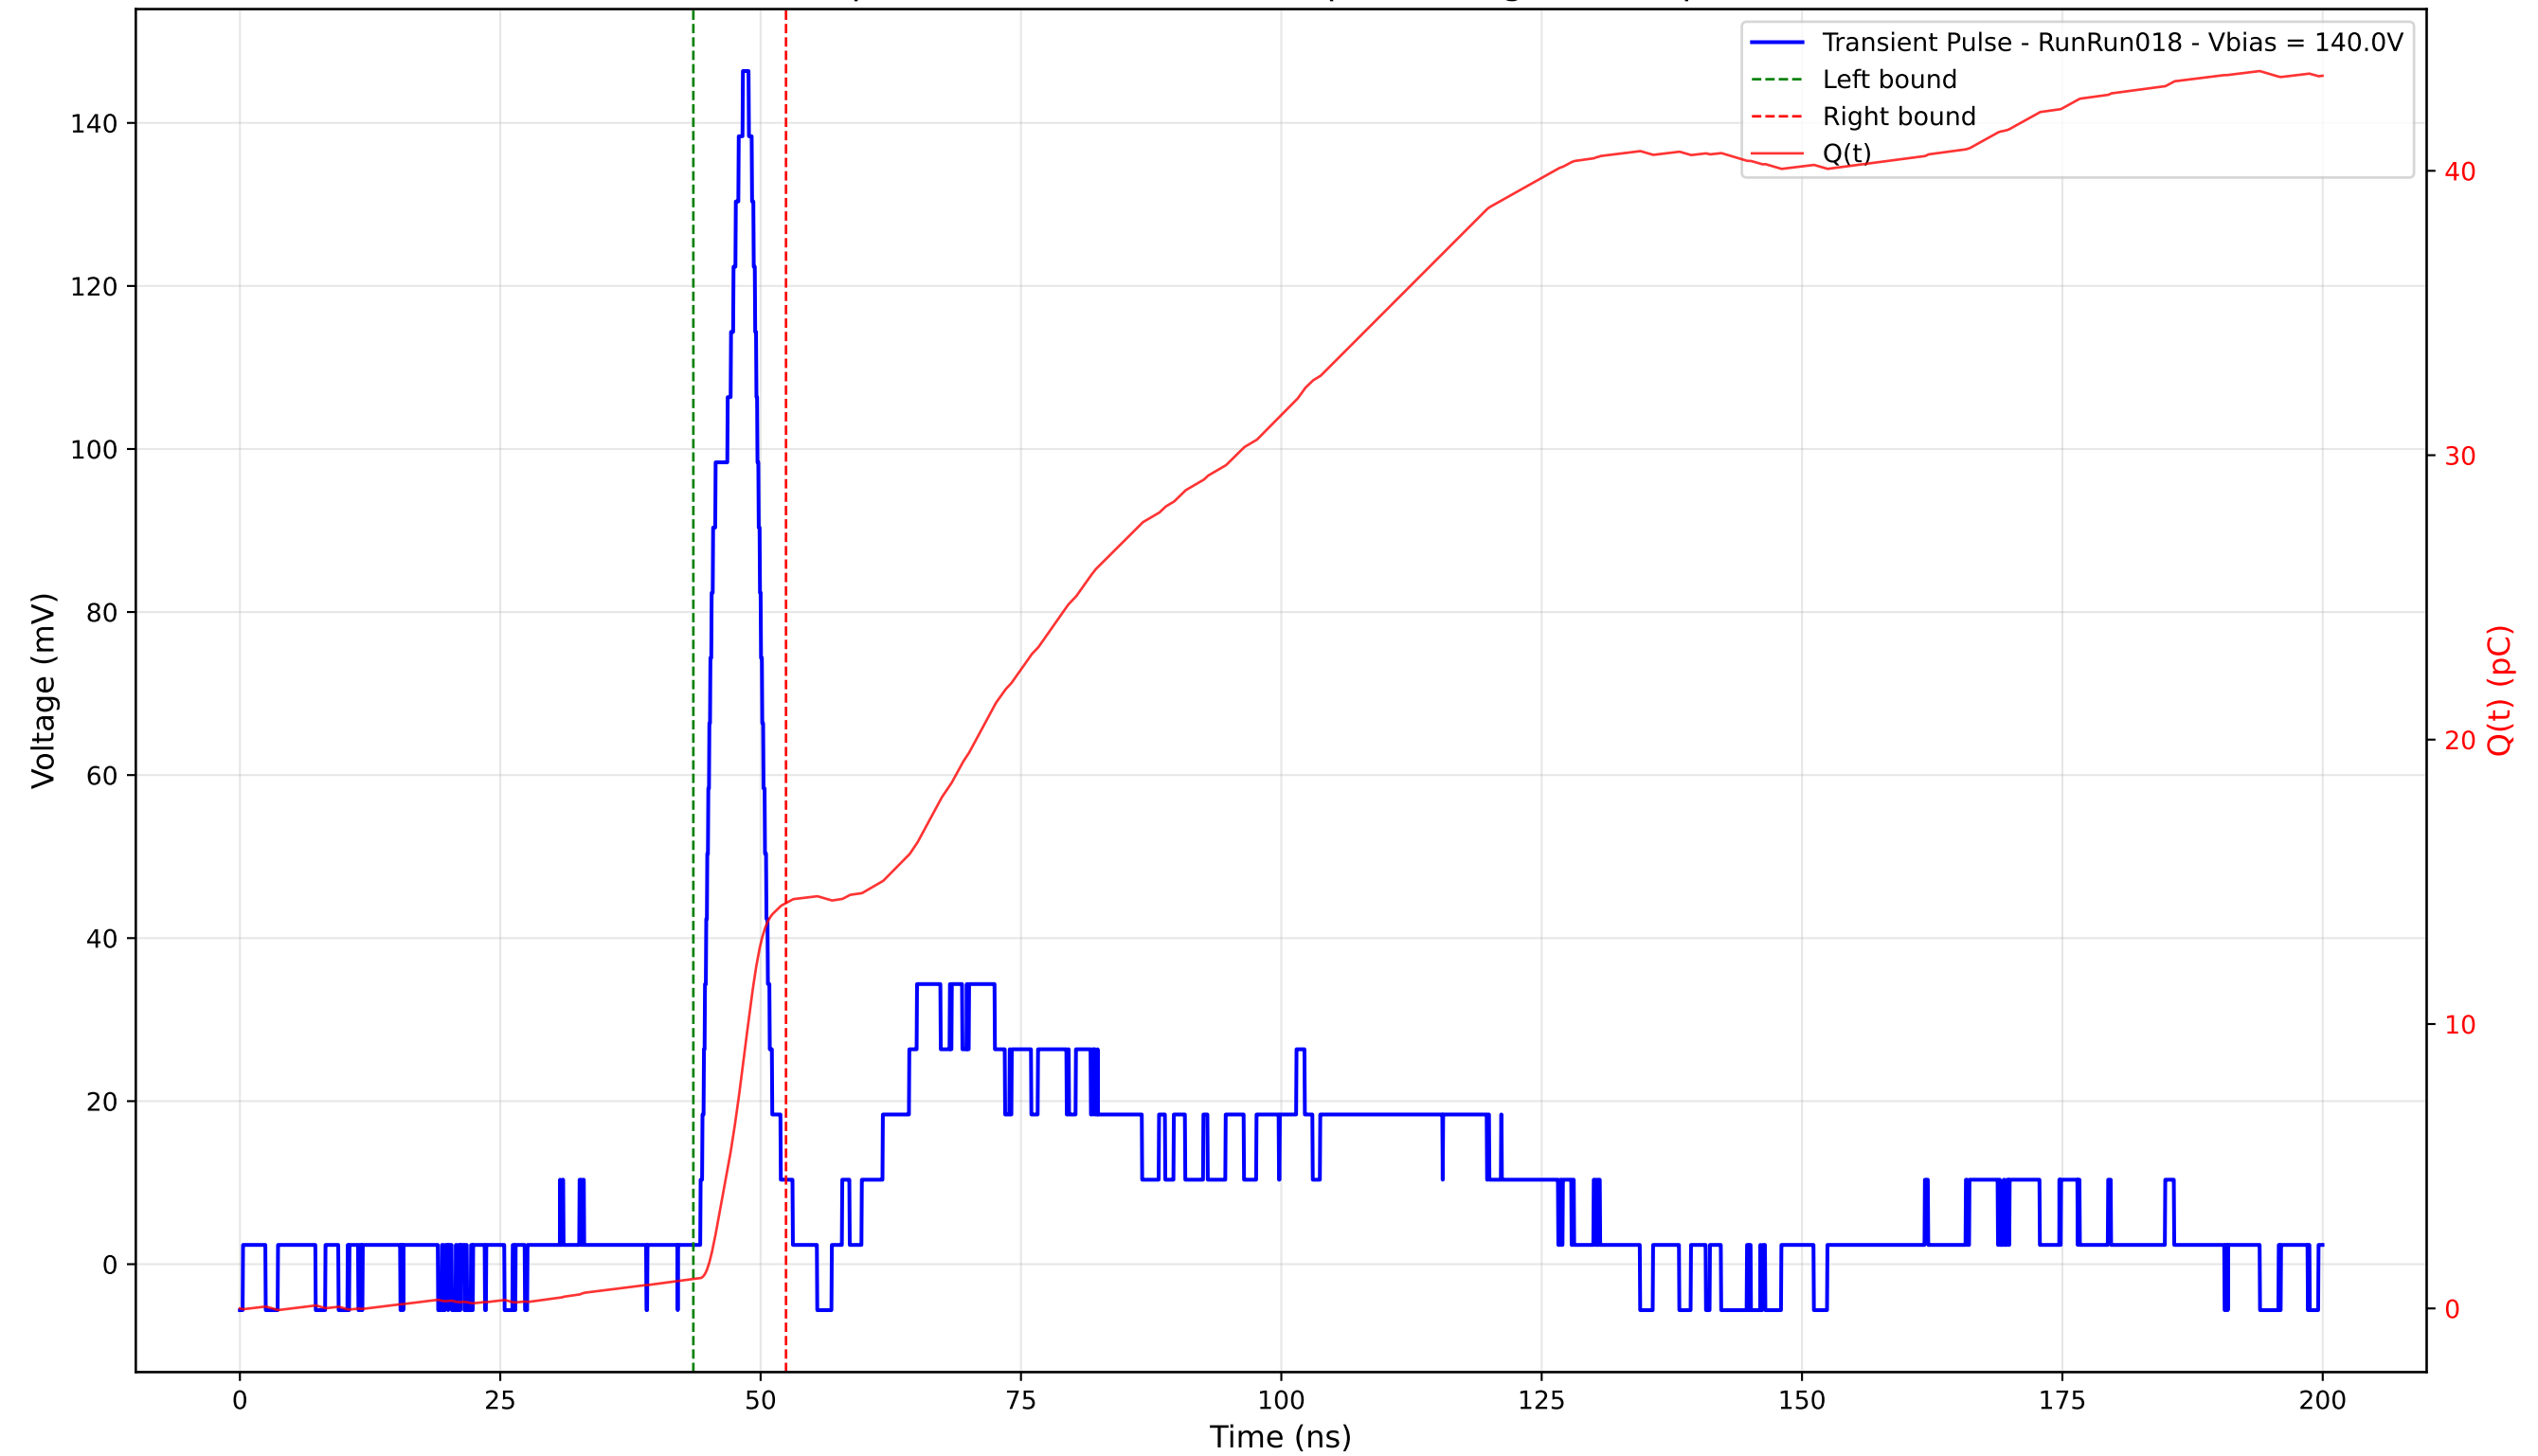


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 11.64 pC - Rise Time: 3.50 ns

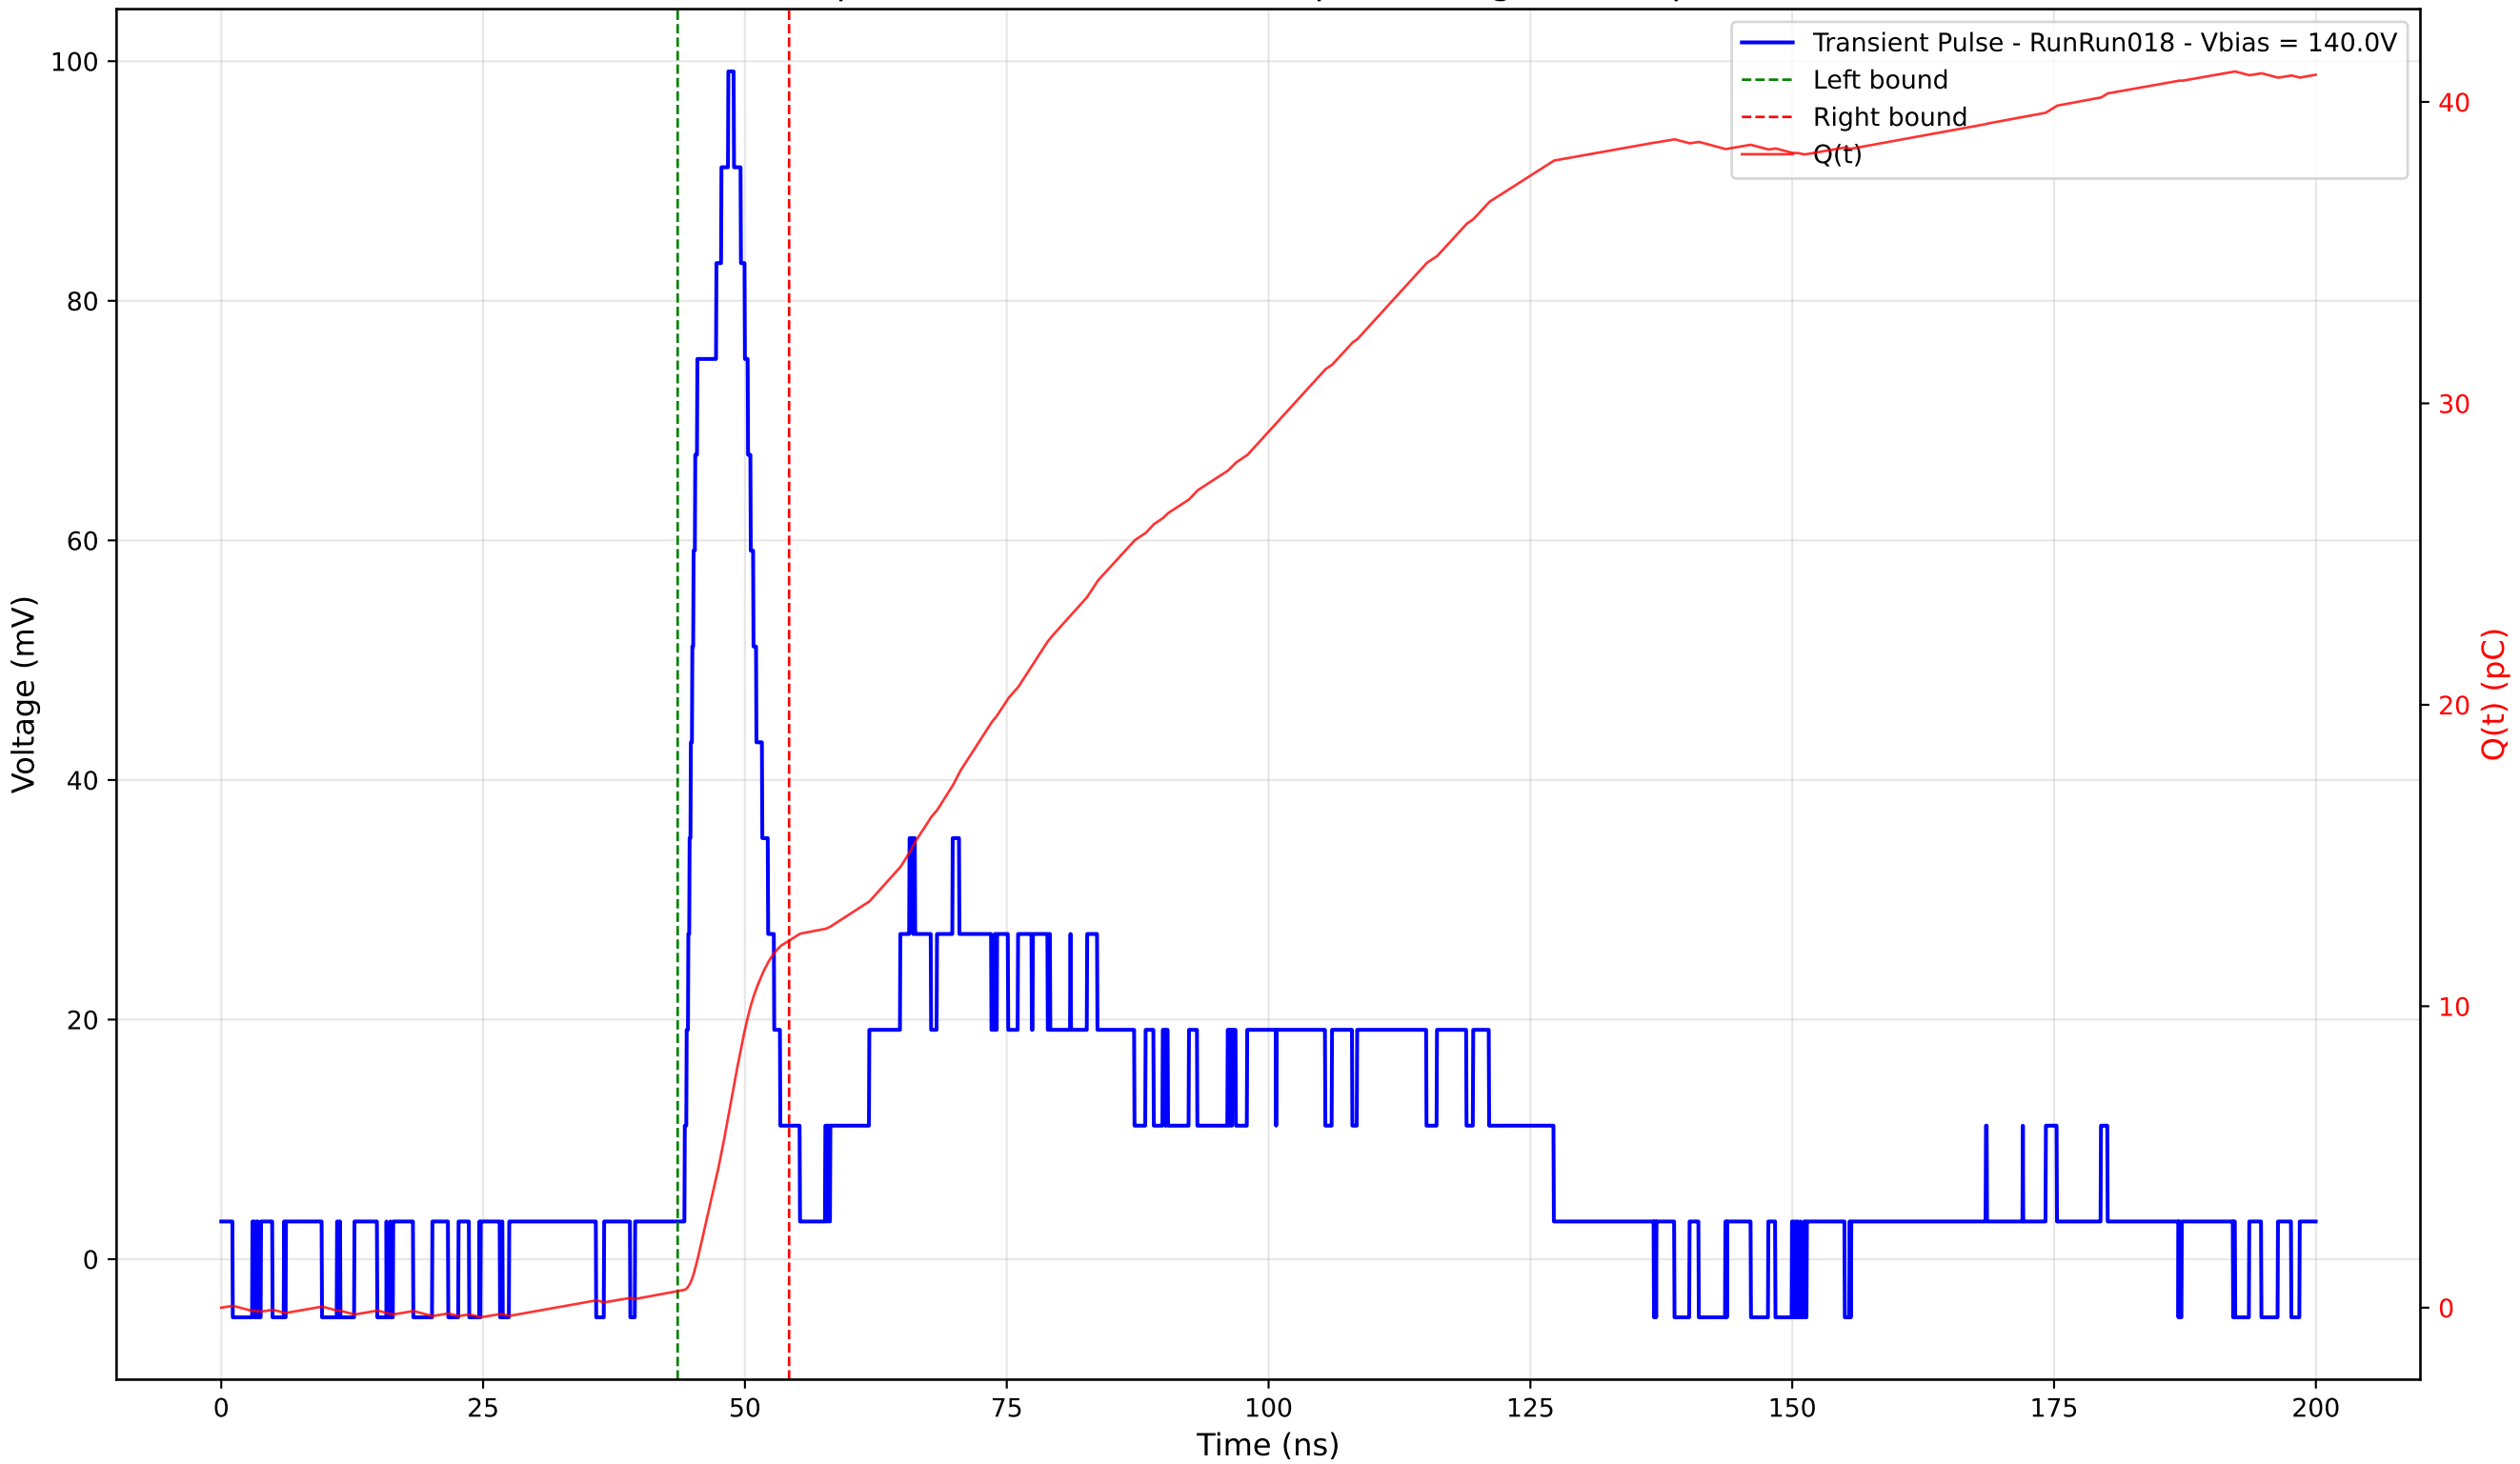


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 9.30 pC - Rise Time: 1.19 ns

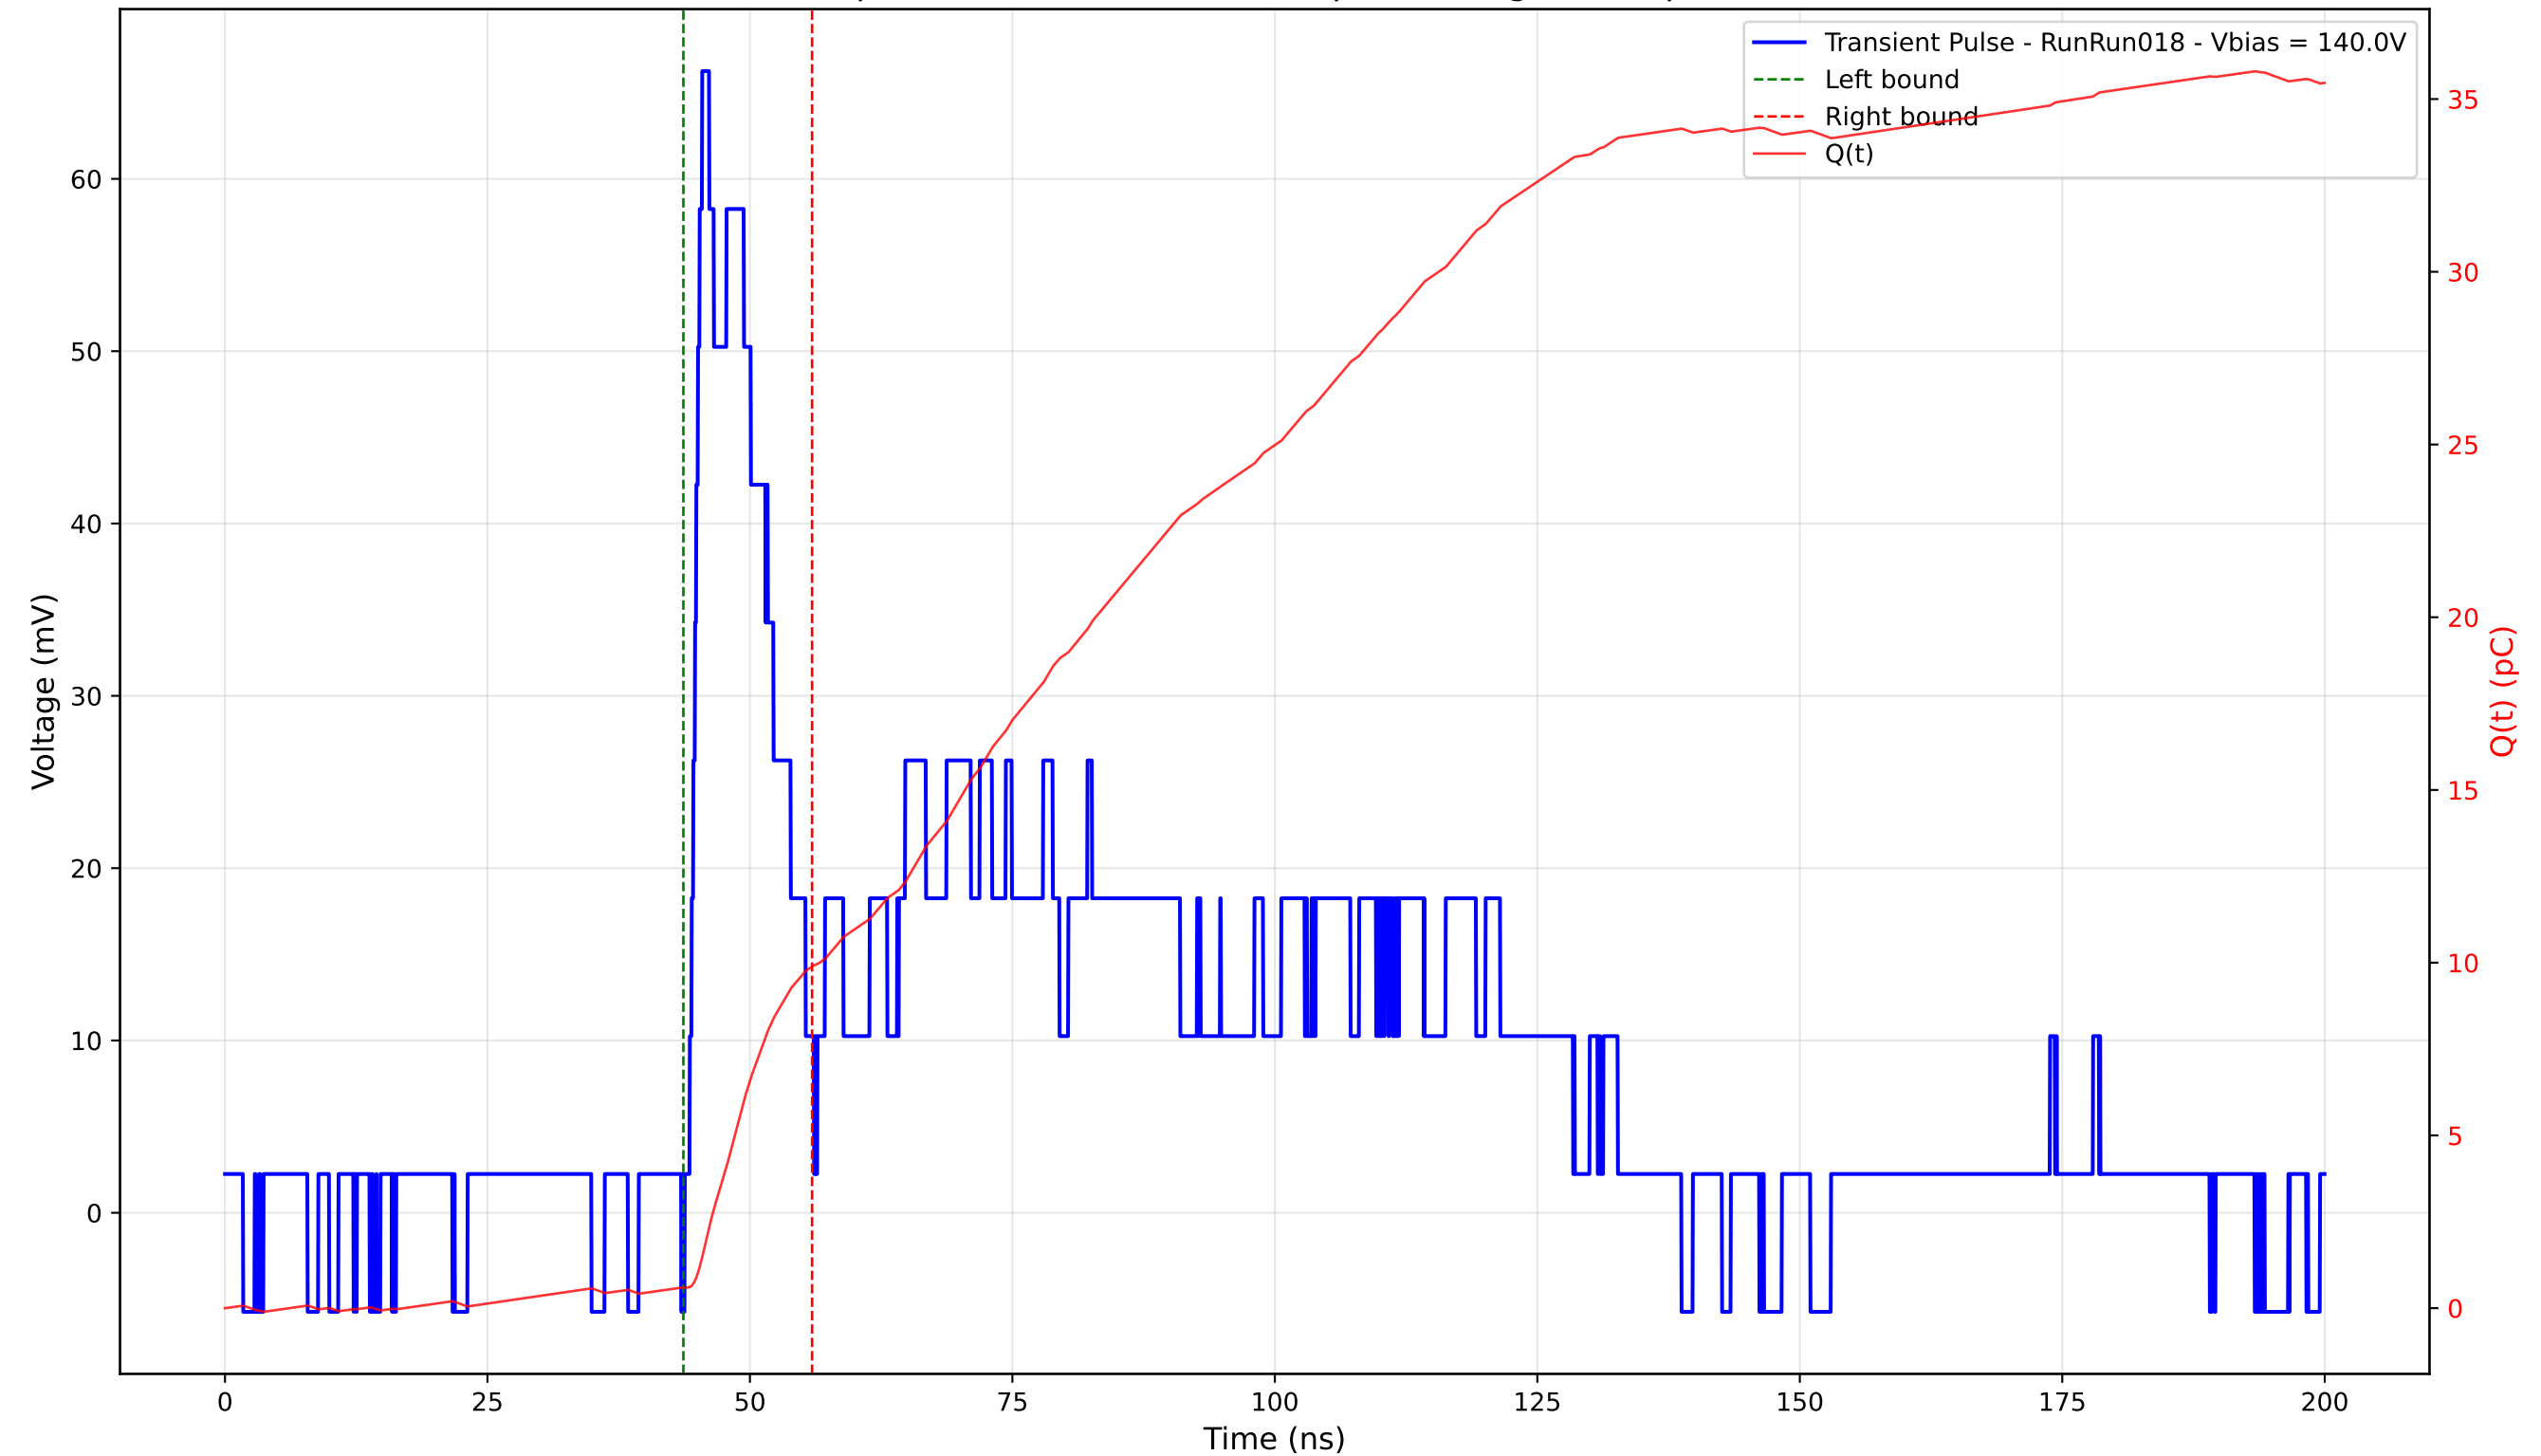


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 48.39 pC - Rise Time: 1.27 ns

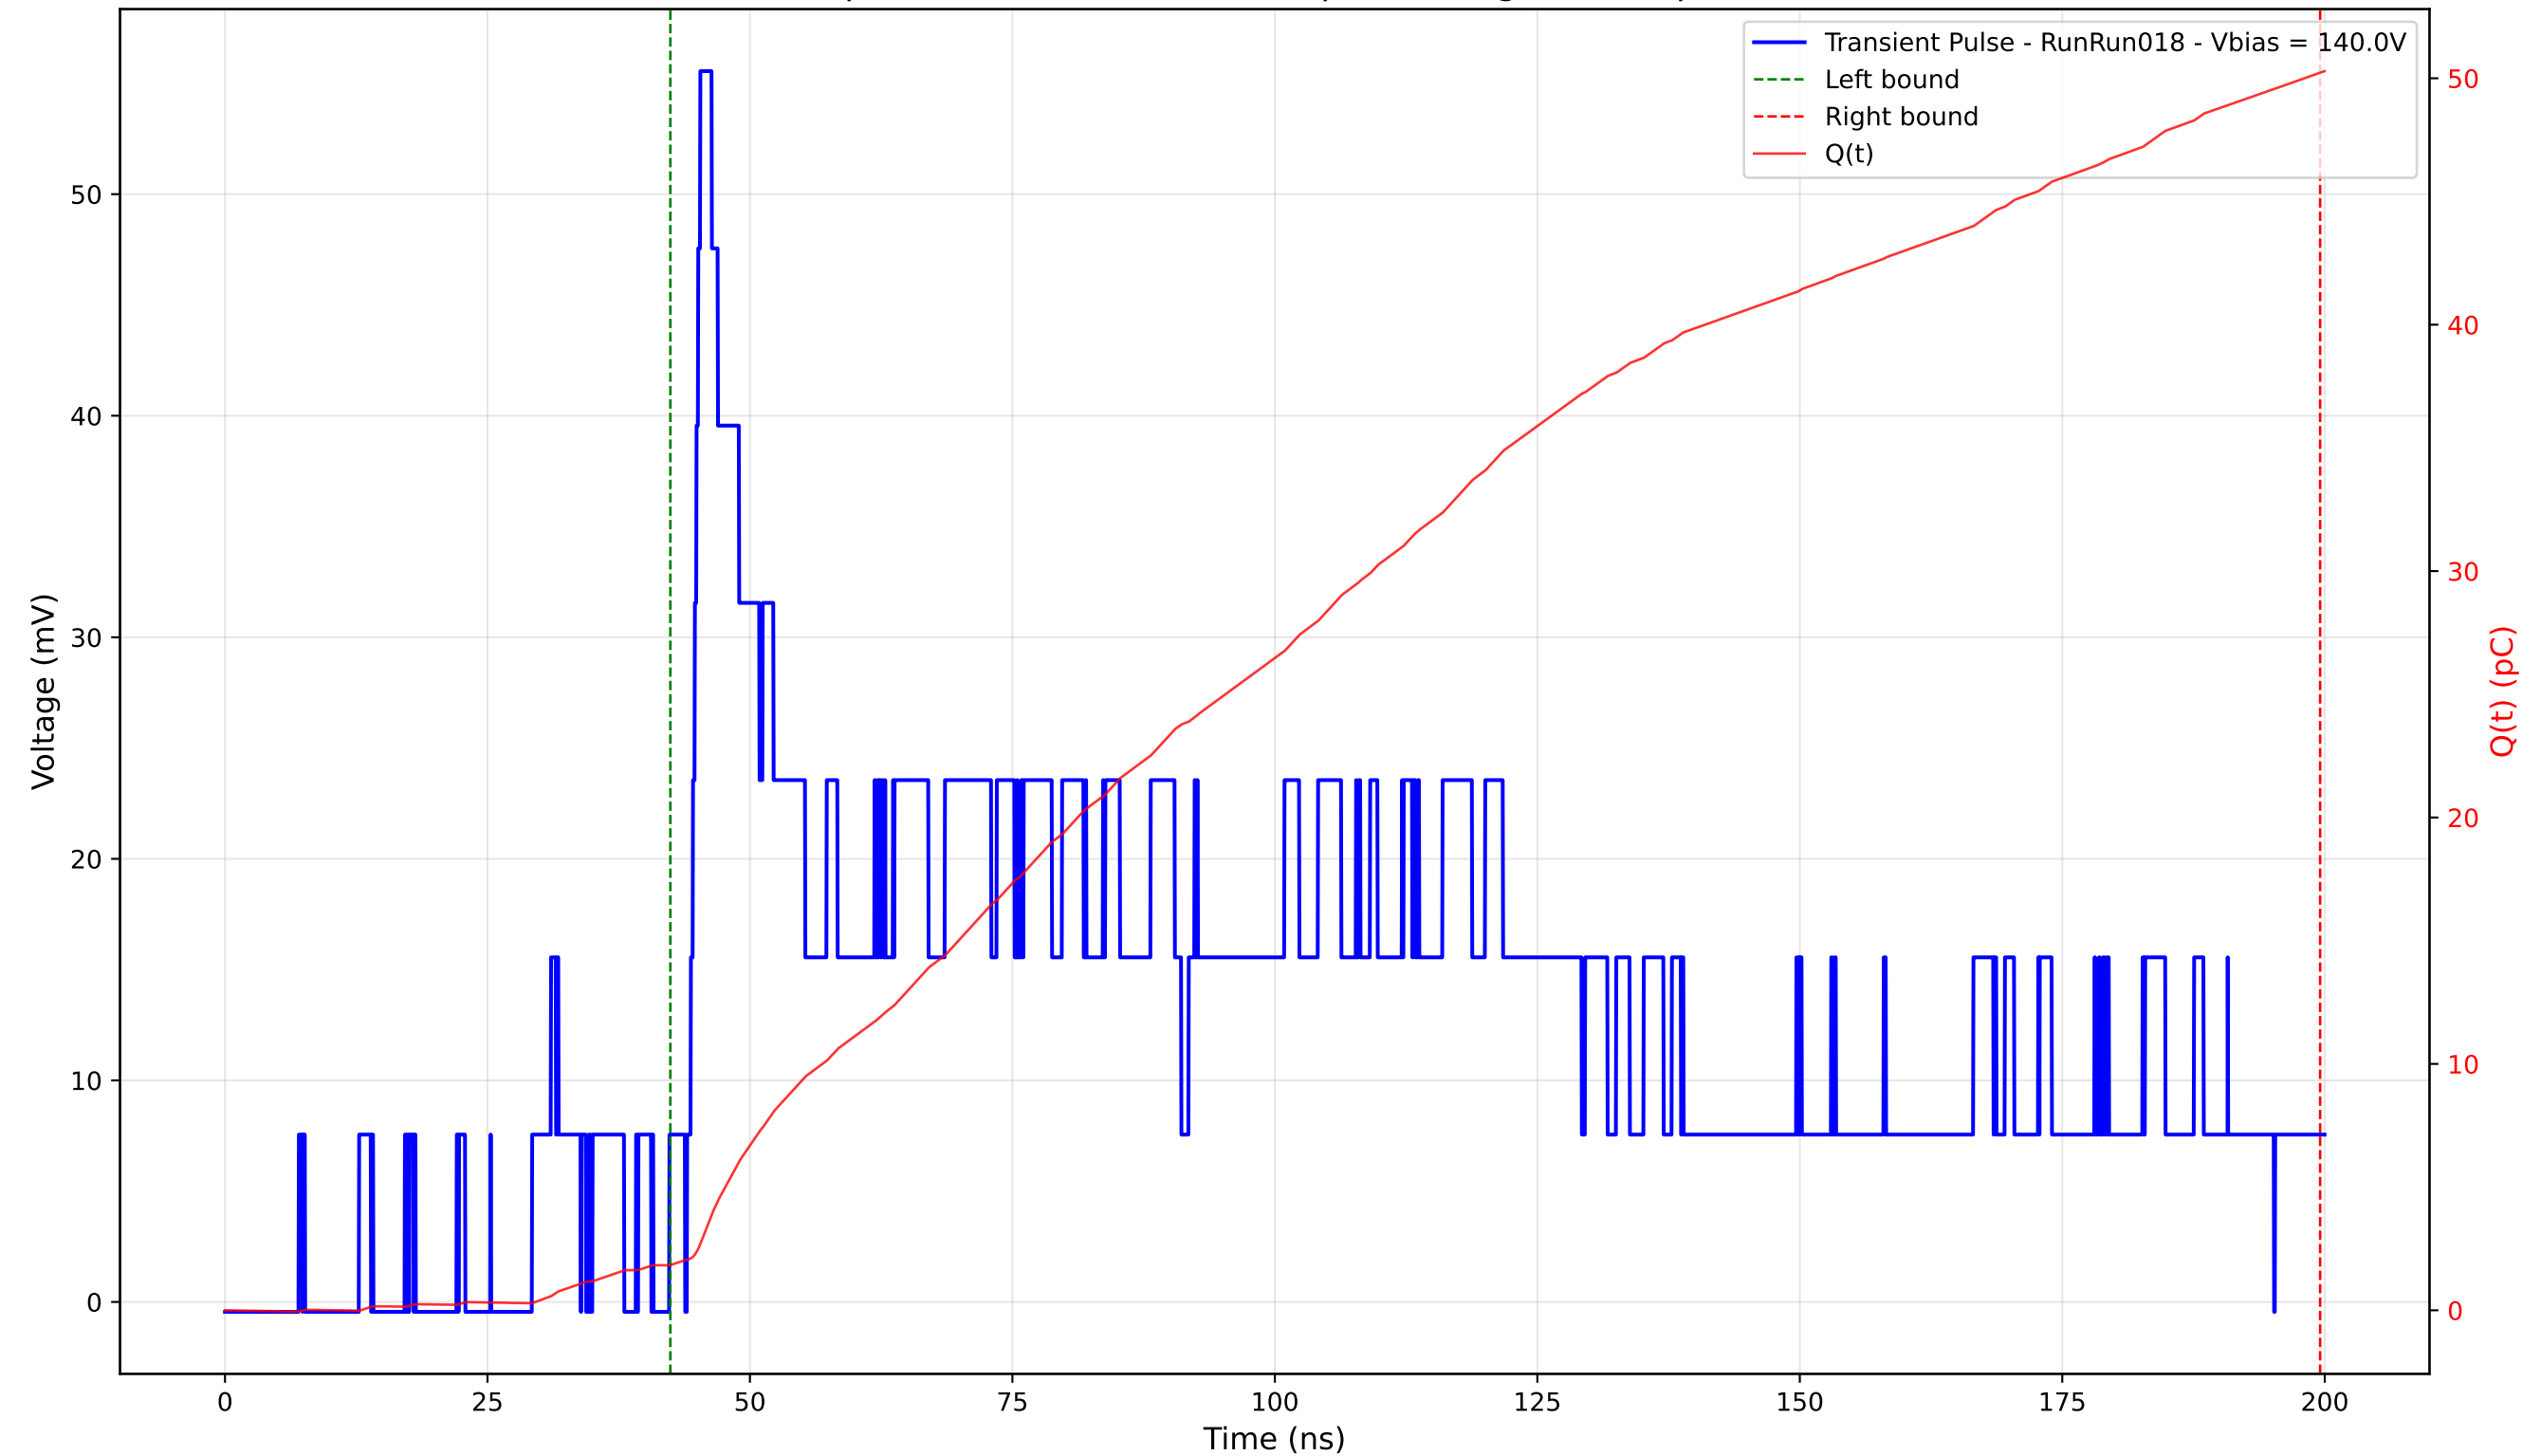


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 28.68 pC - Rise Time: 1.29 ns

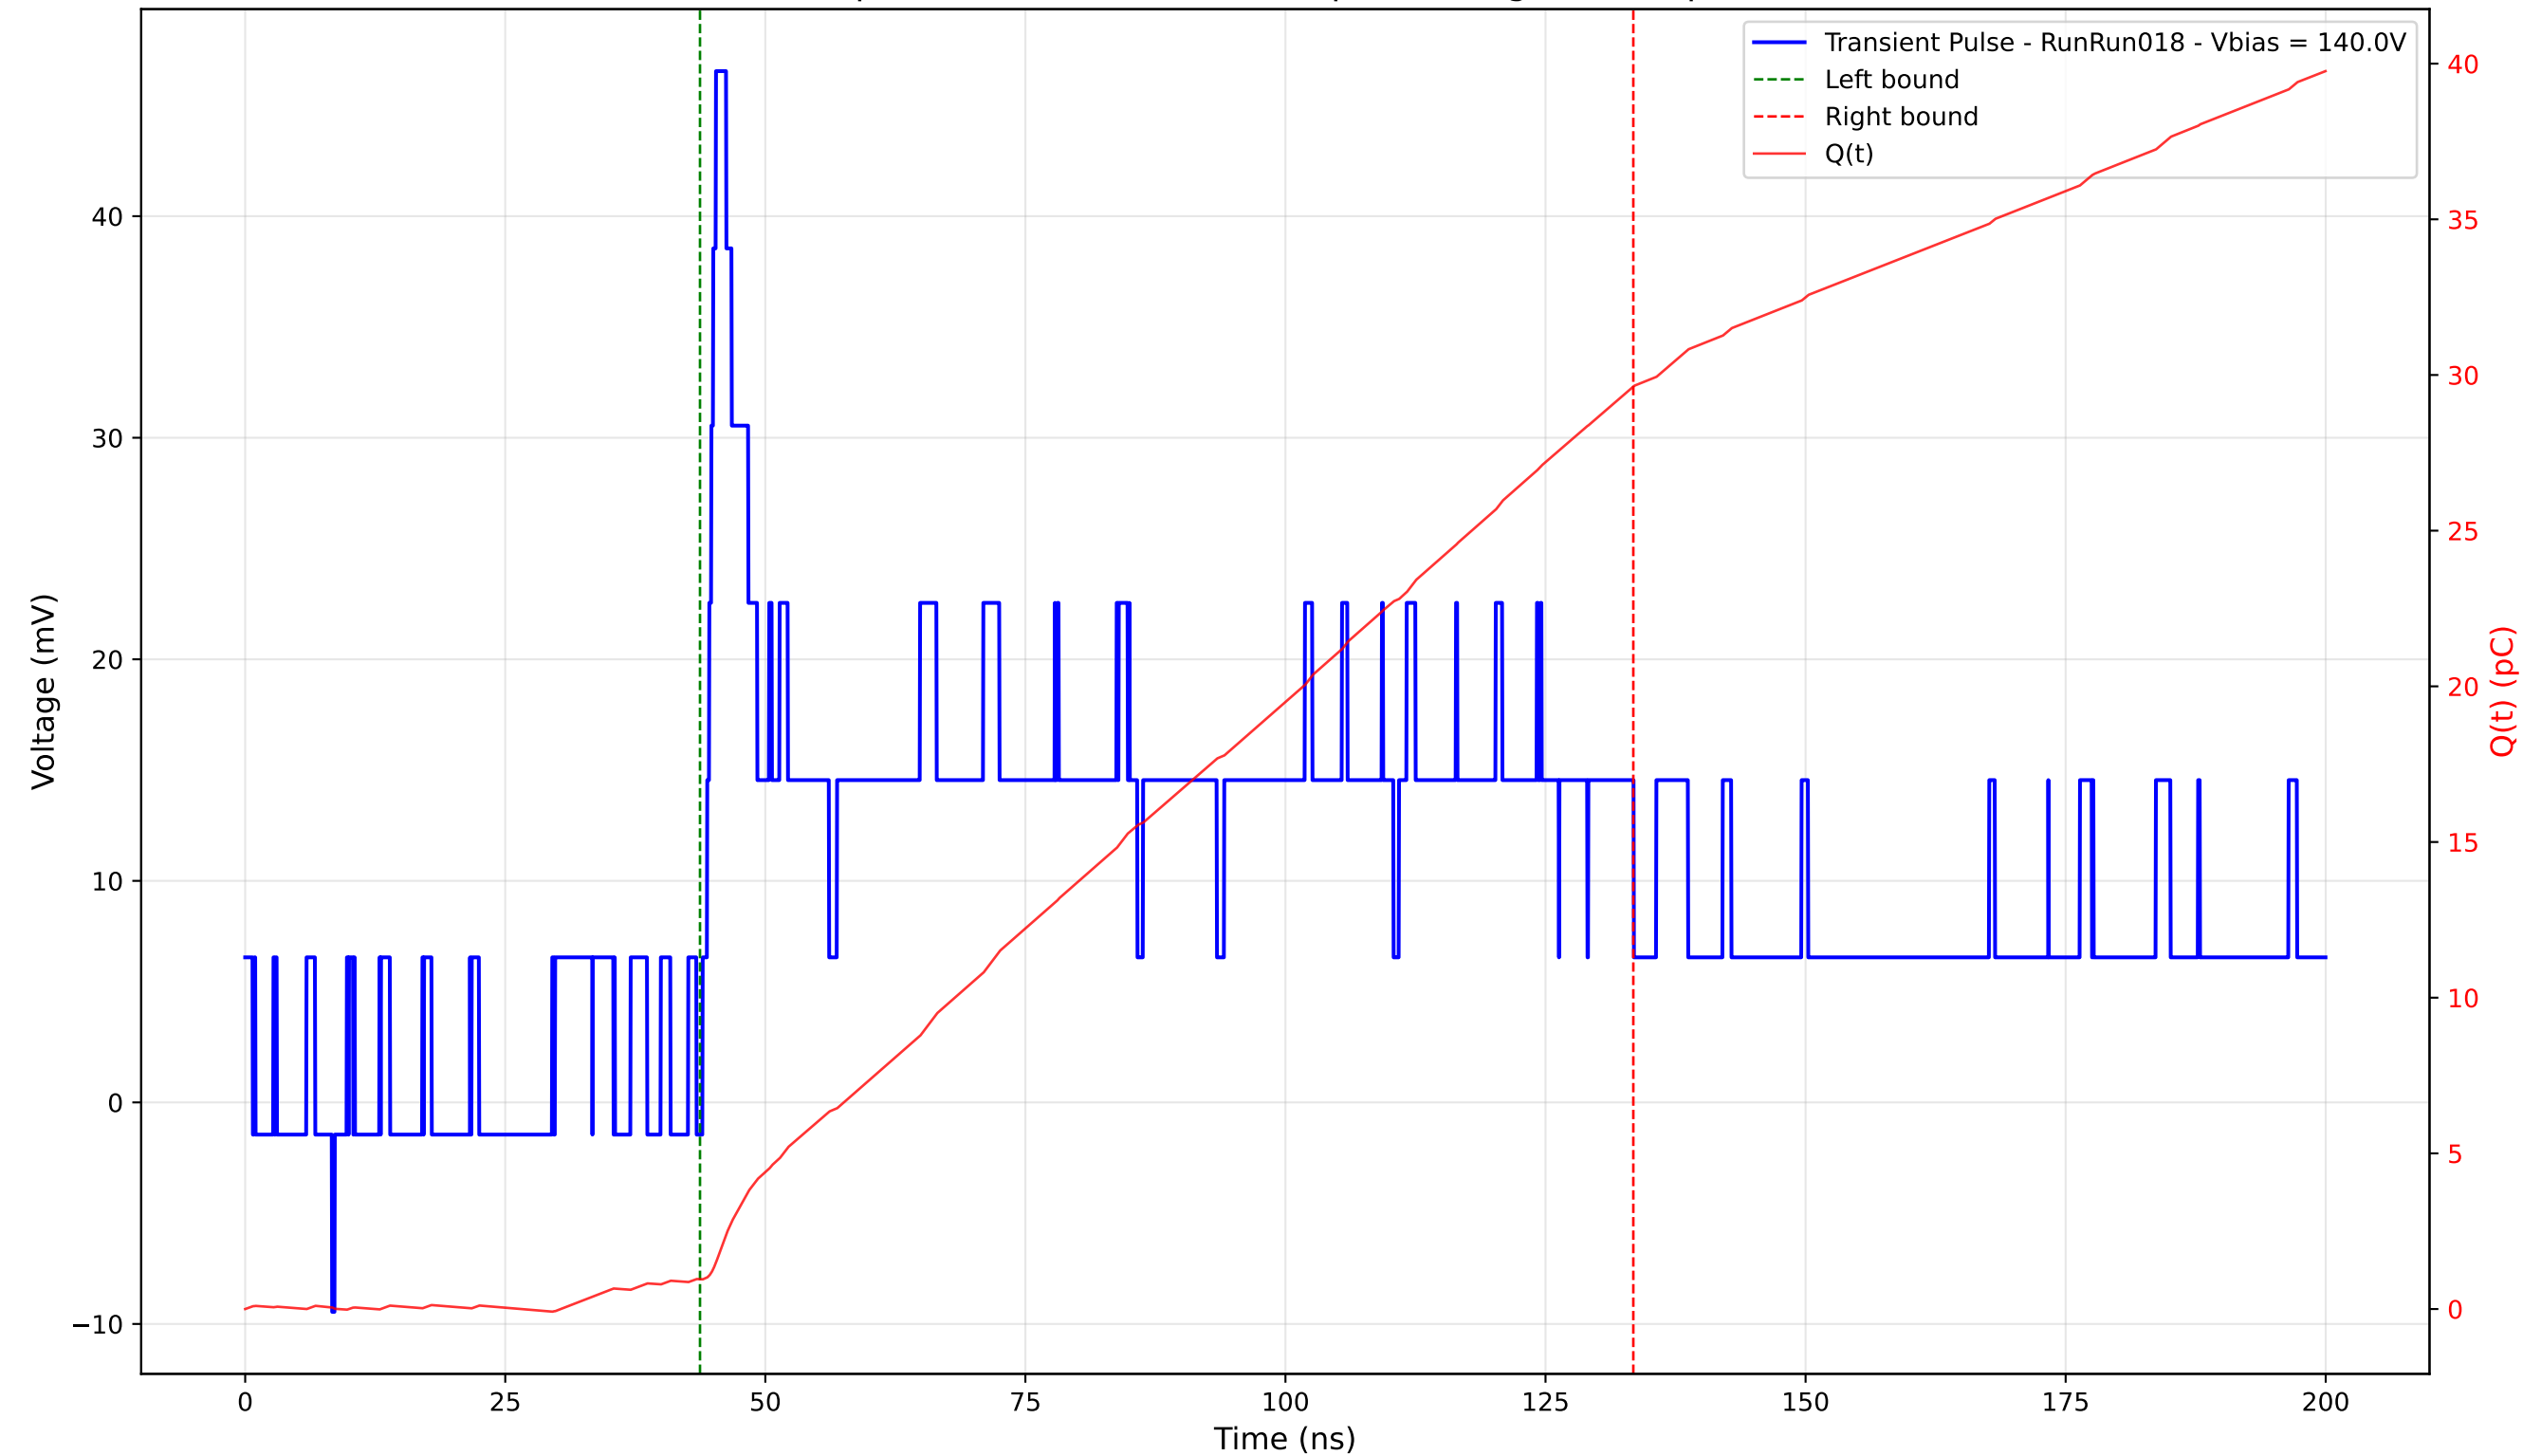


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 3.29 pC - Rise Time: 1.00 ns

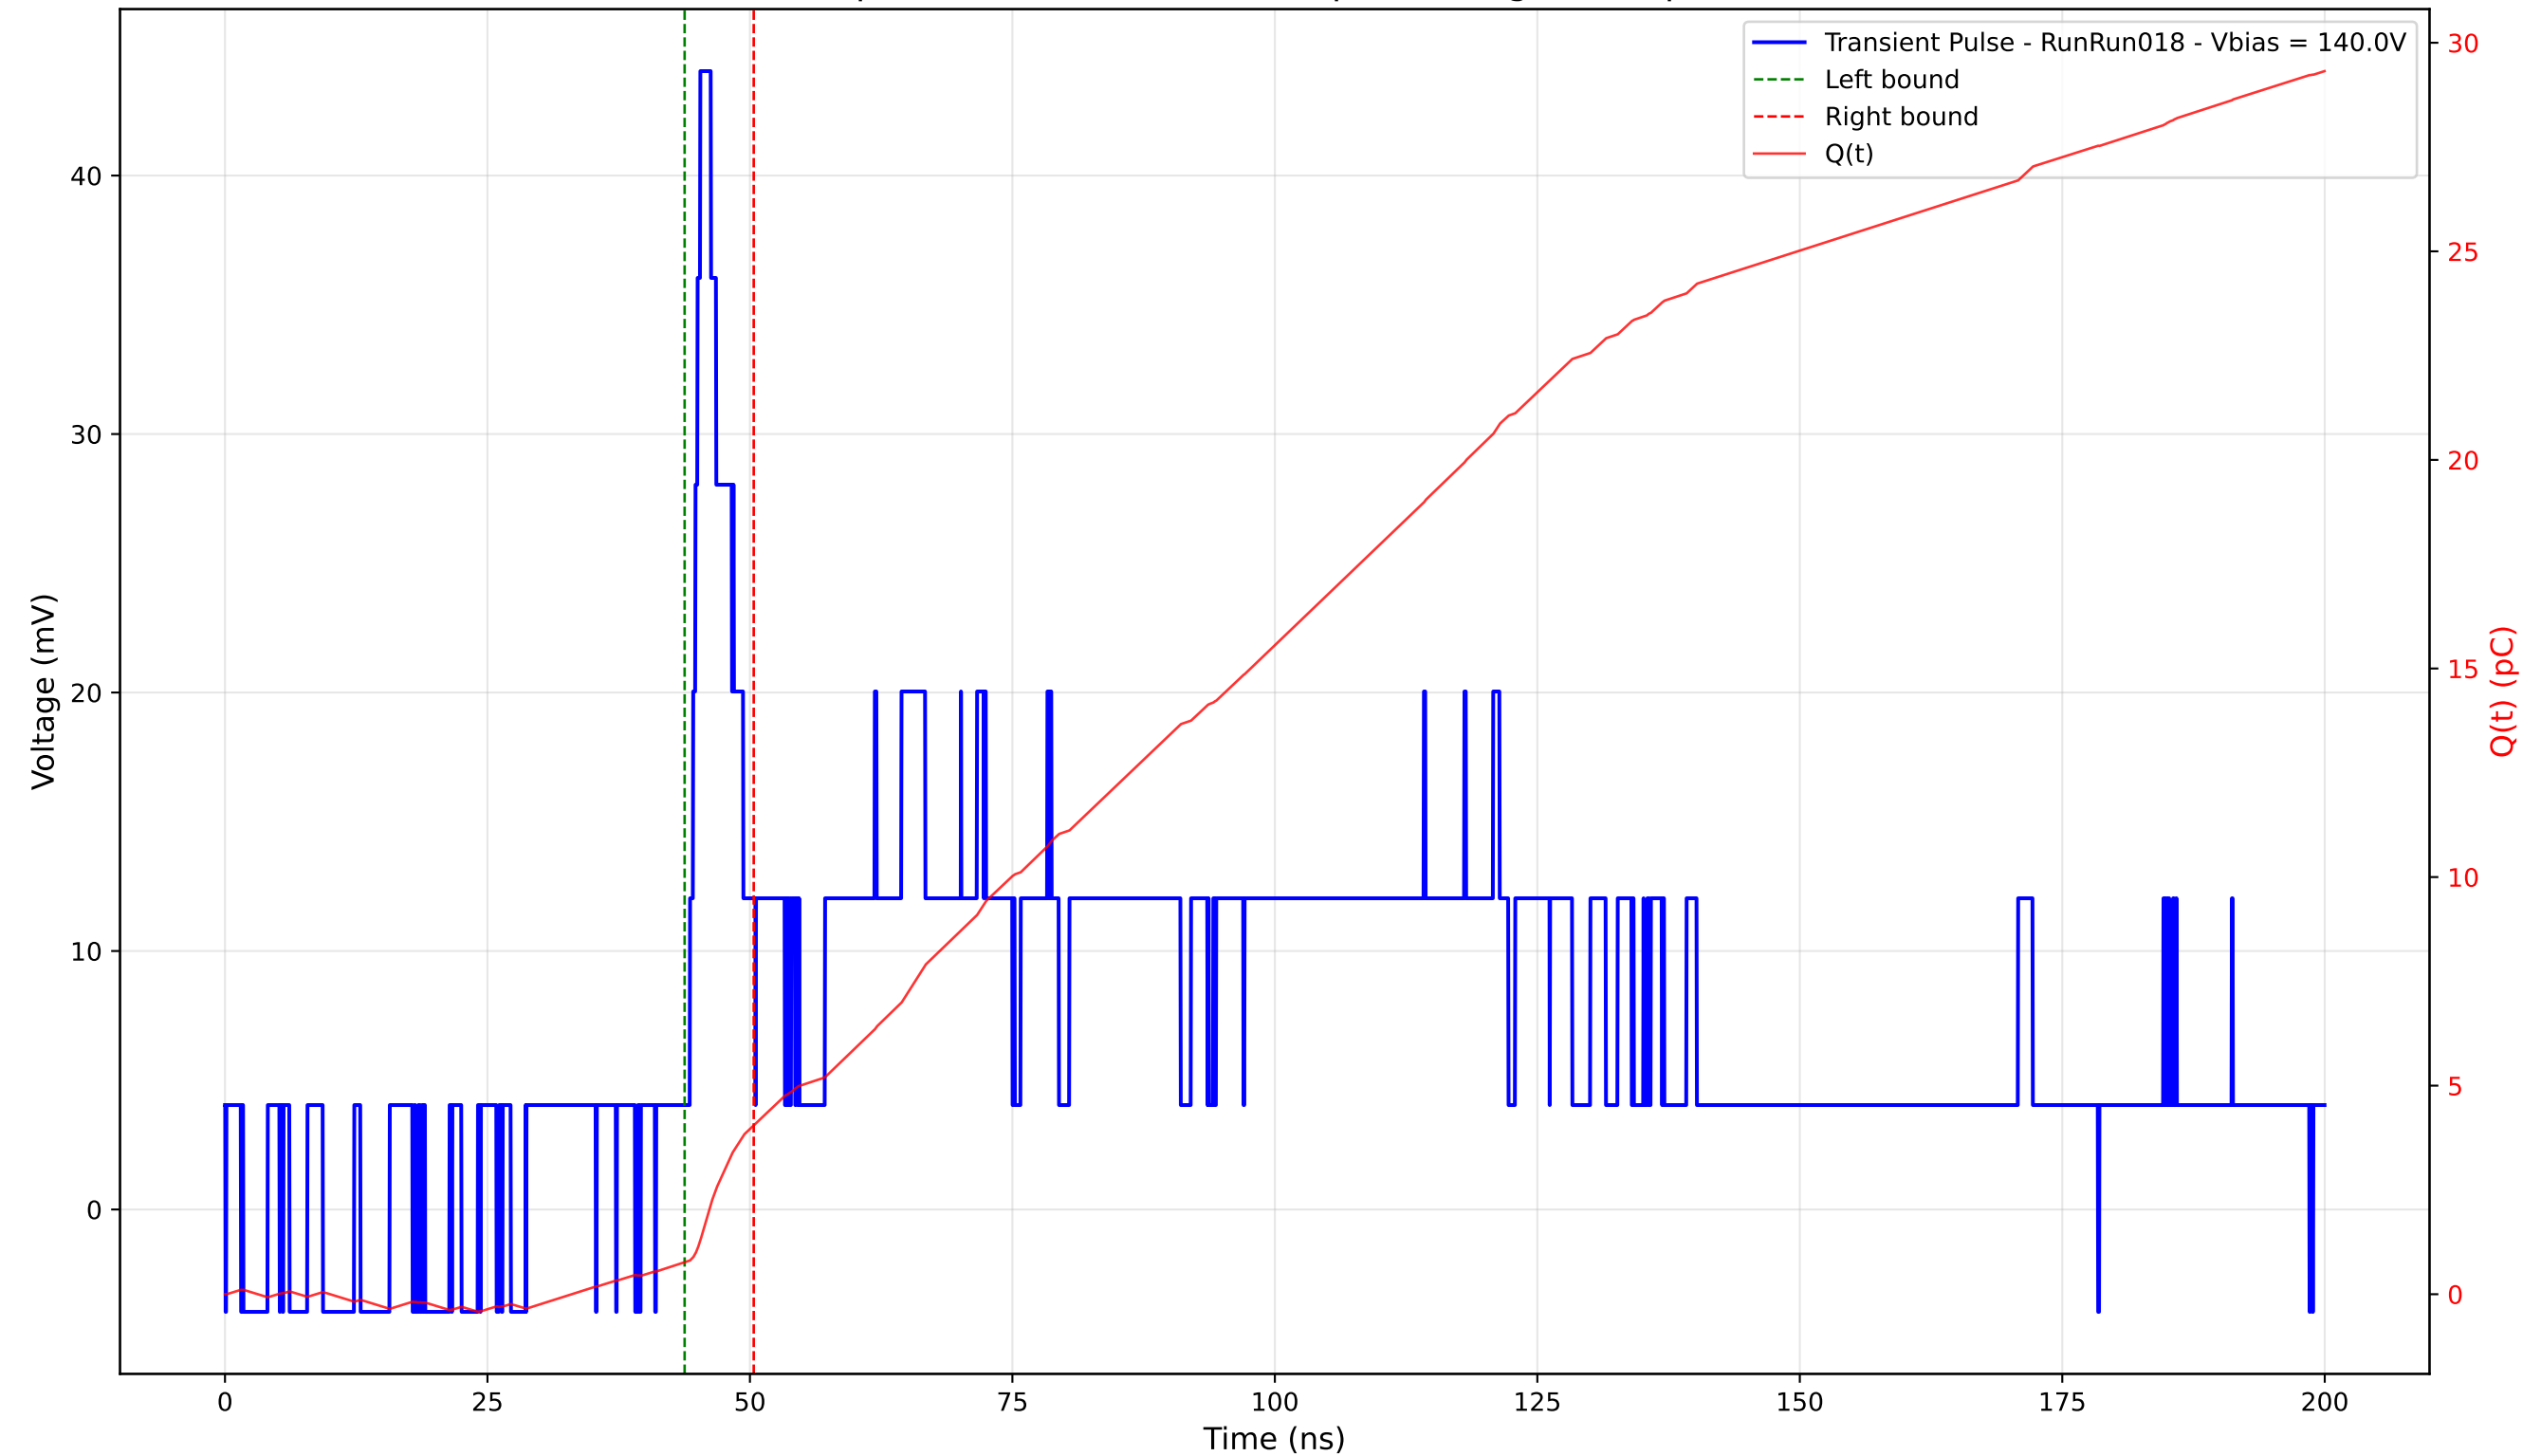


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 2.97 pC - Rise Time: 0.95 ns

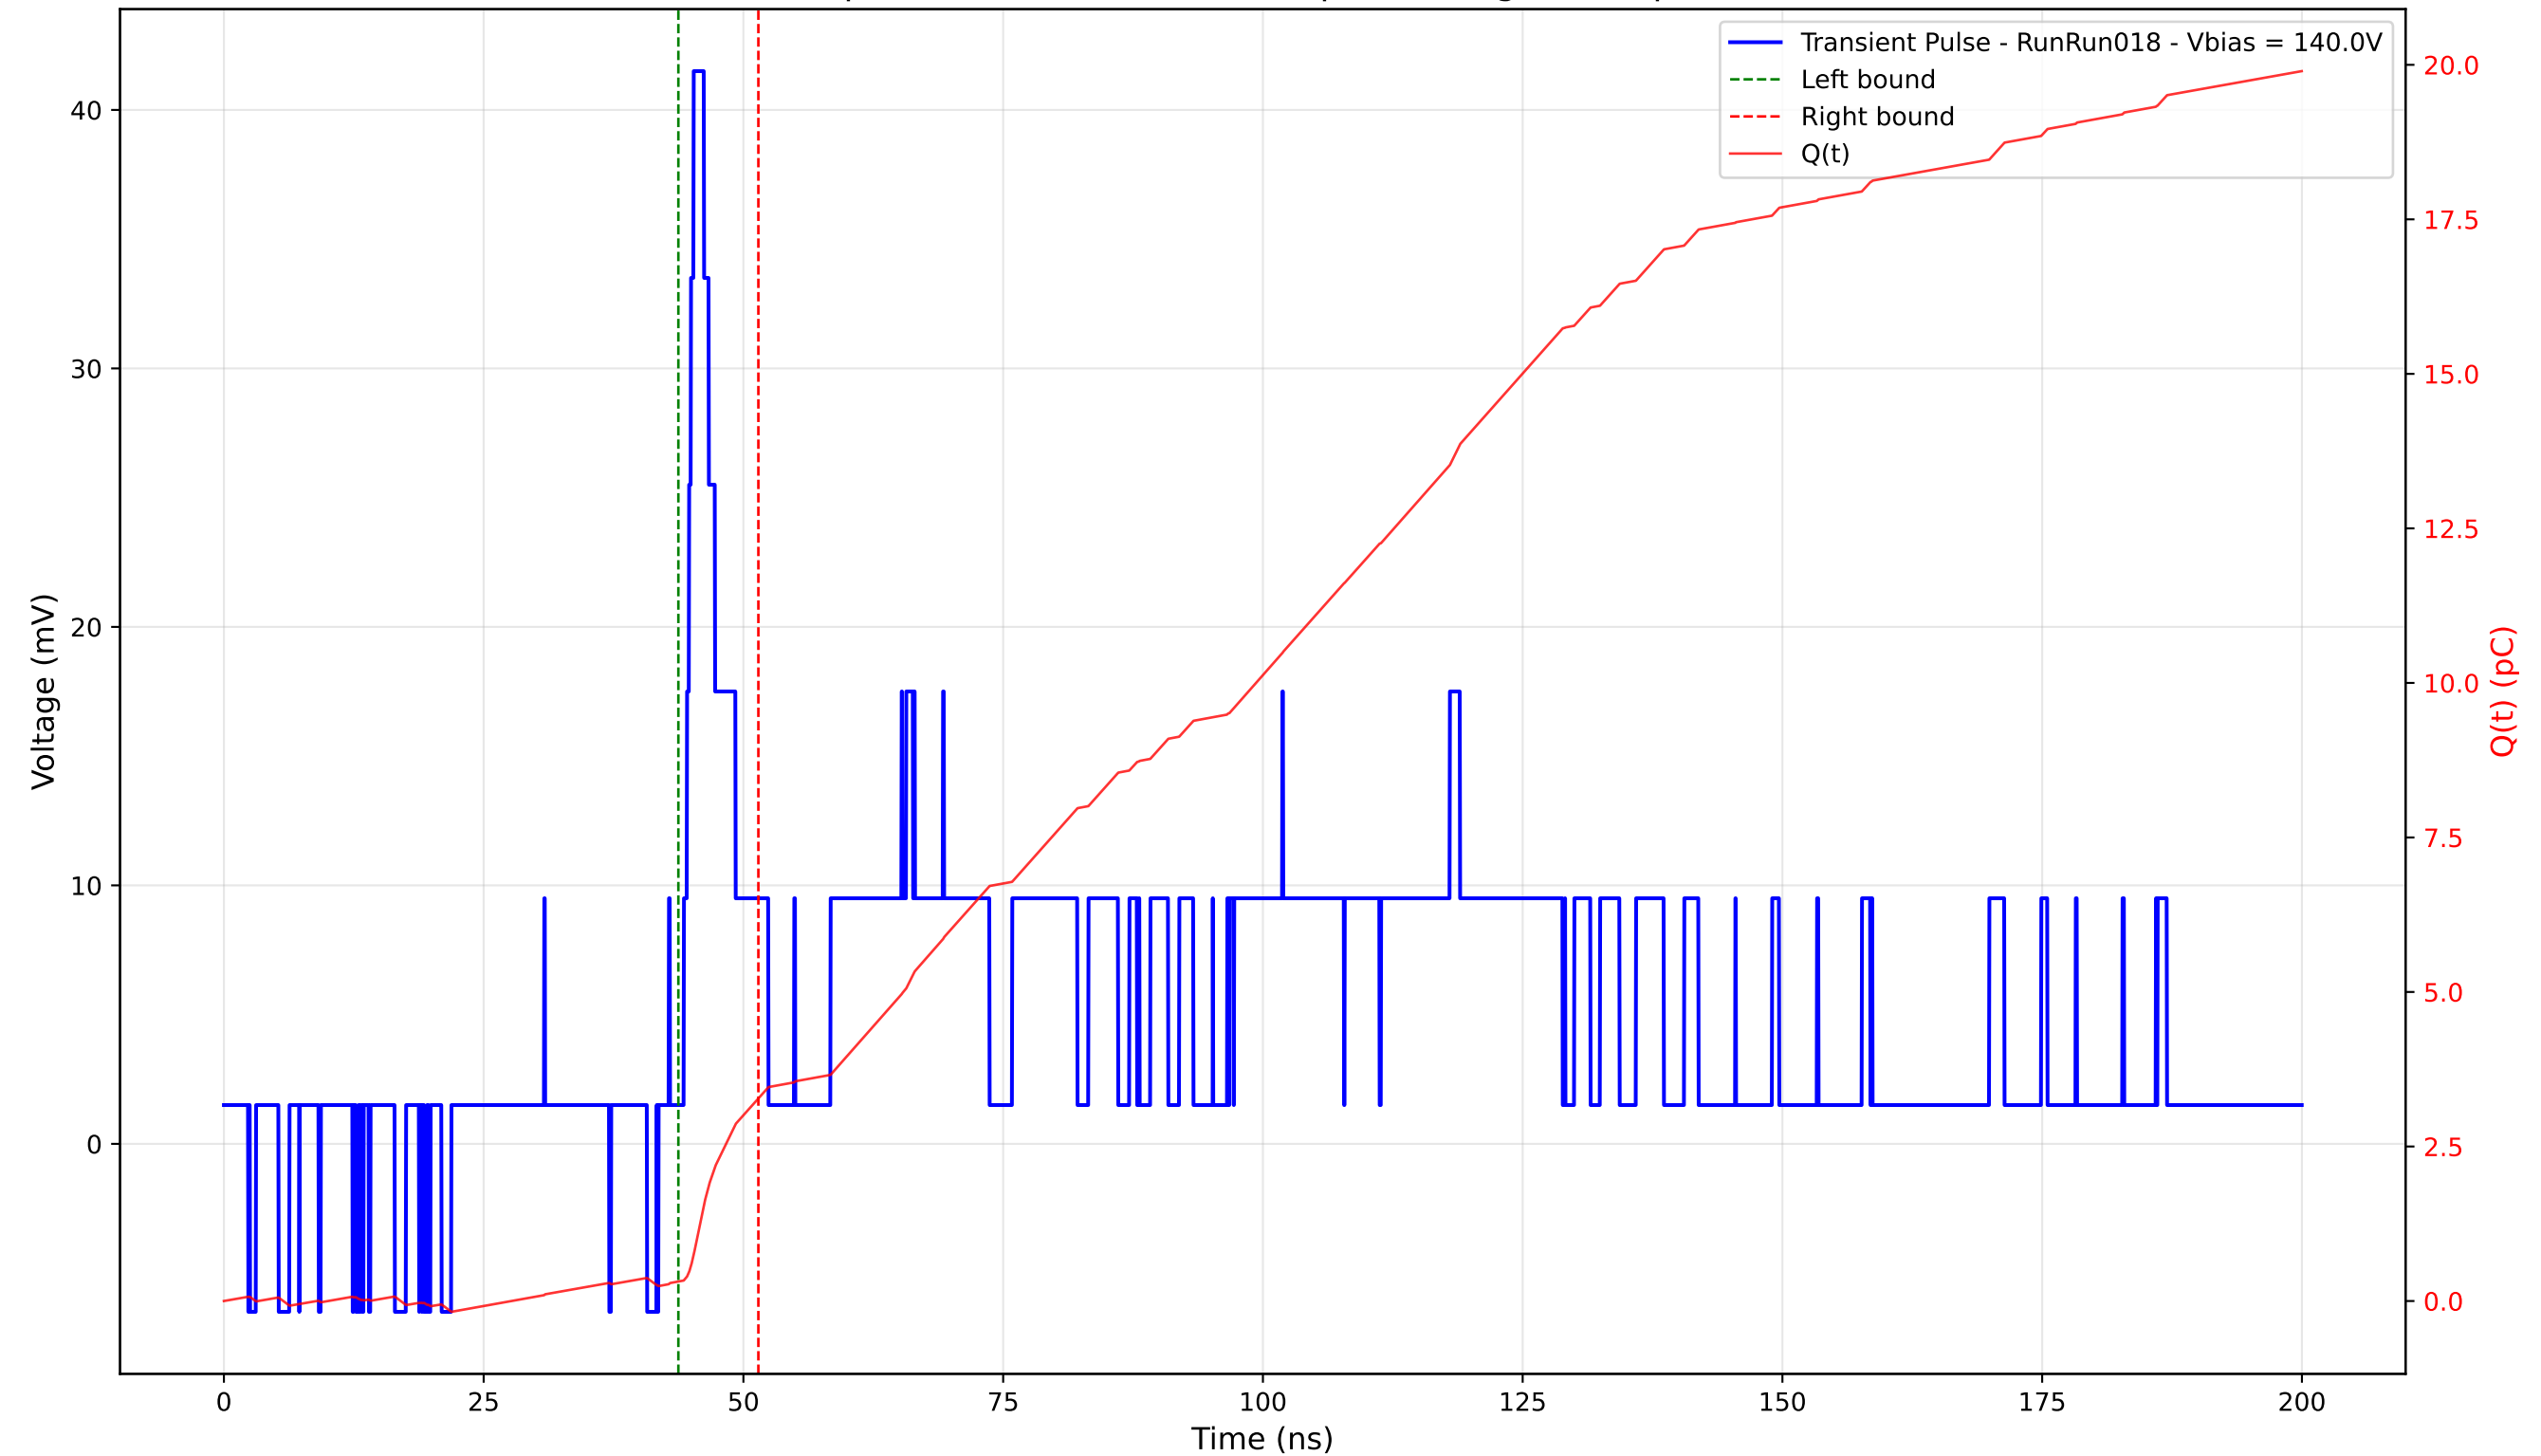


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 2.13 pC - Rise Time: 0.92 ns

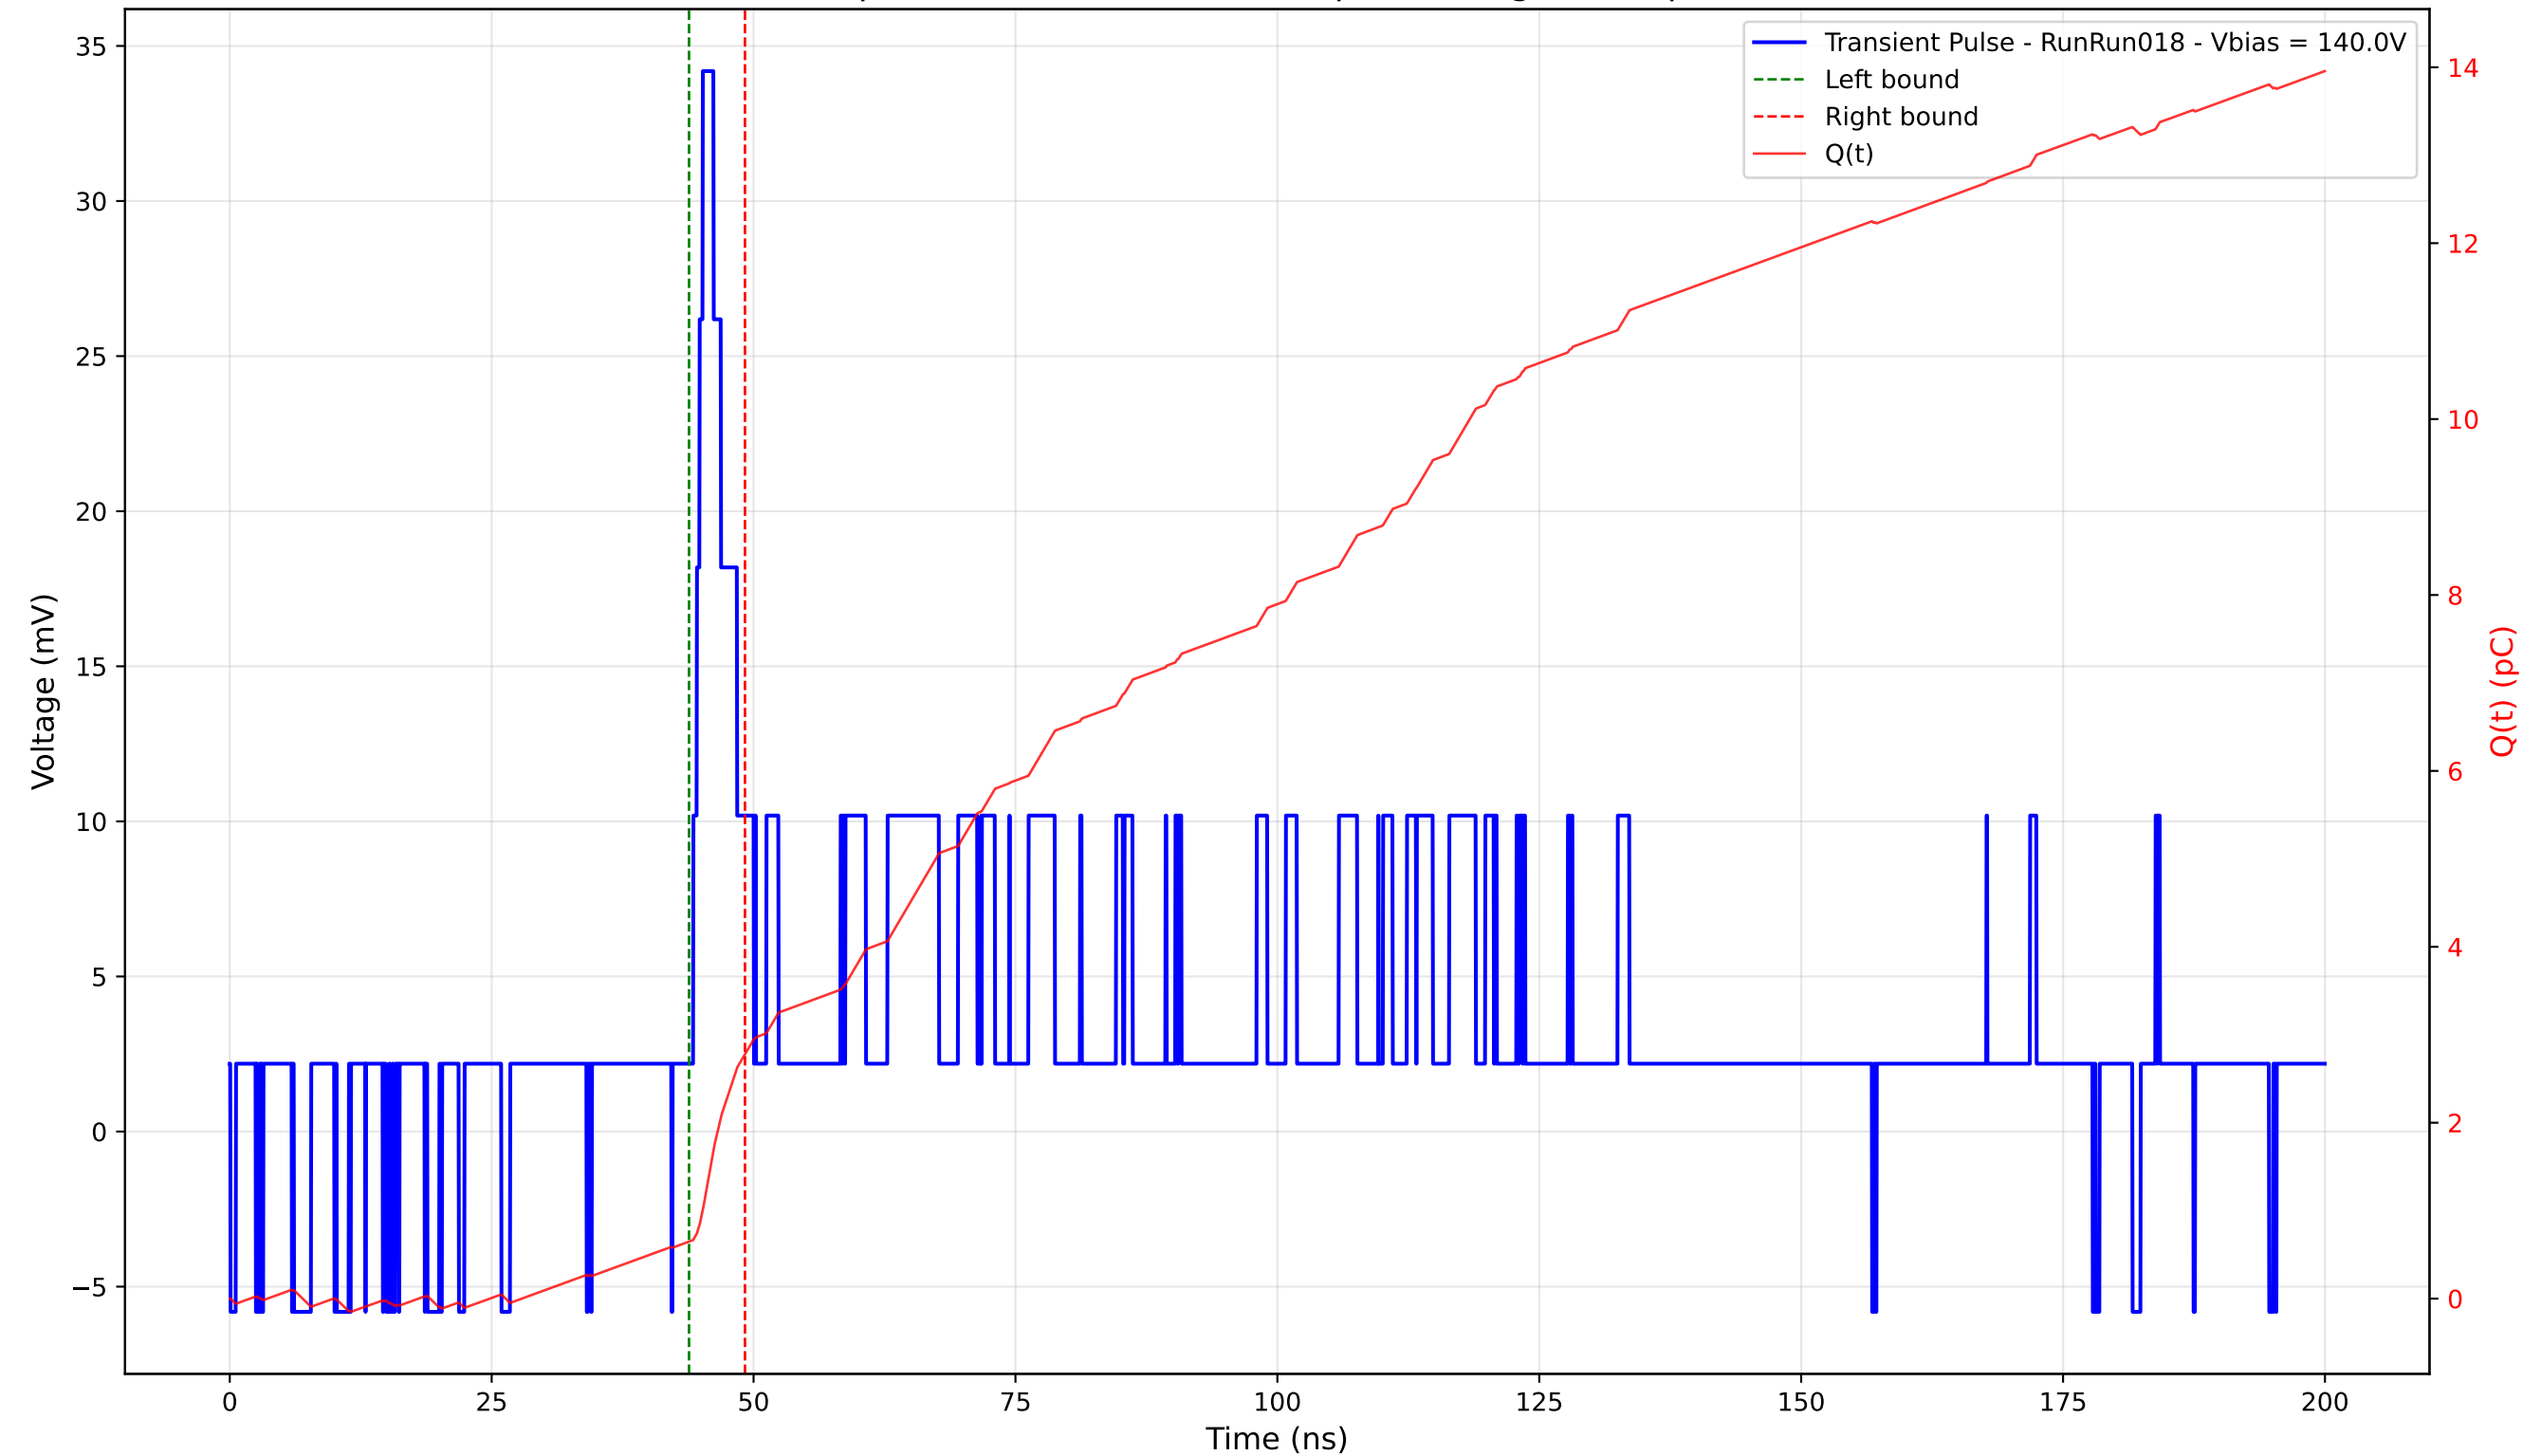


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 2.08 pC - Rise Time: 0.87 ns

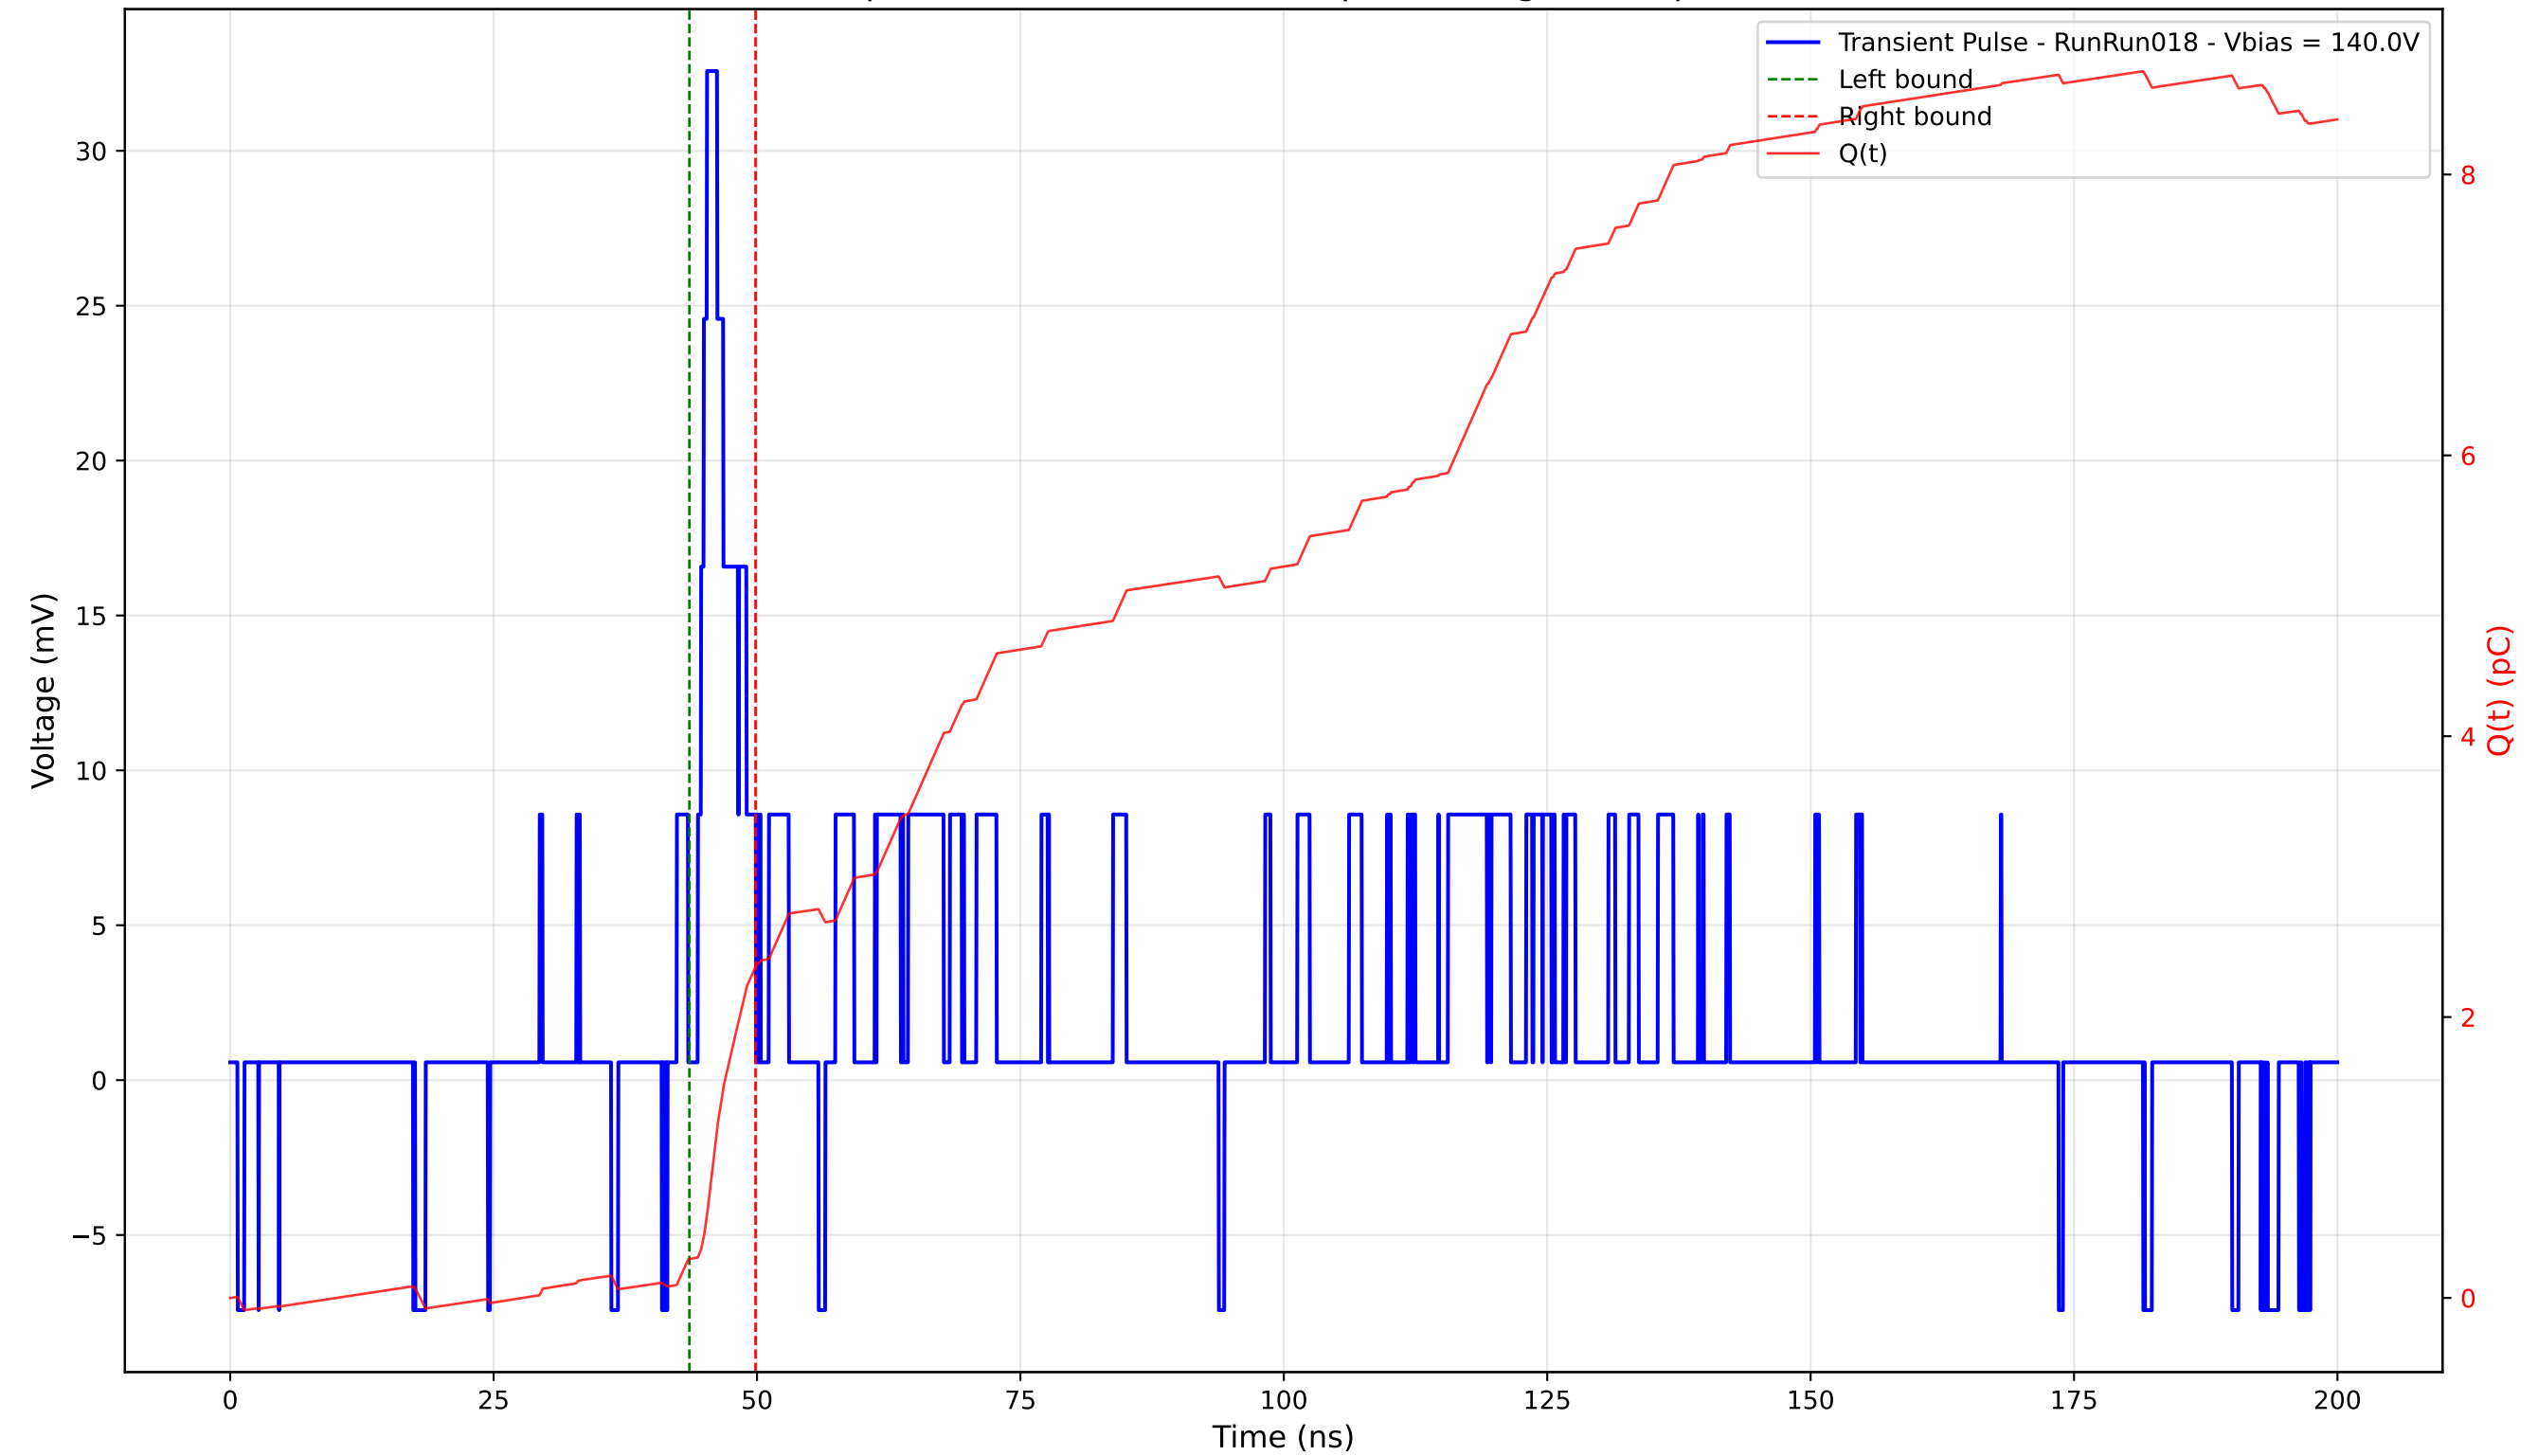


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 1.83 pC - Rise Time: 0.90 ns

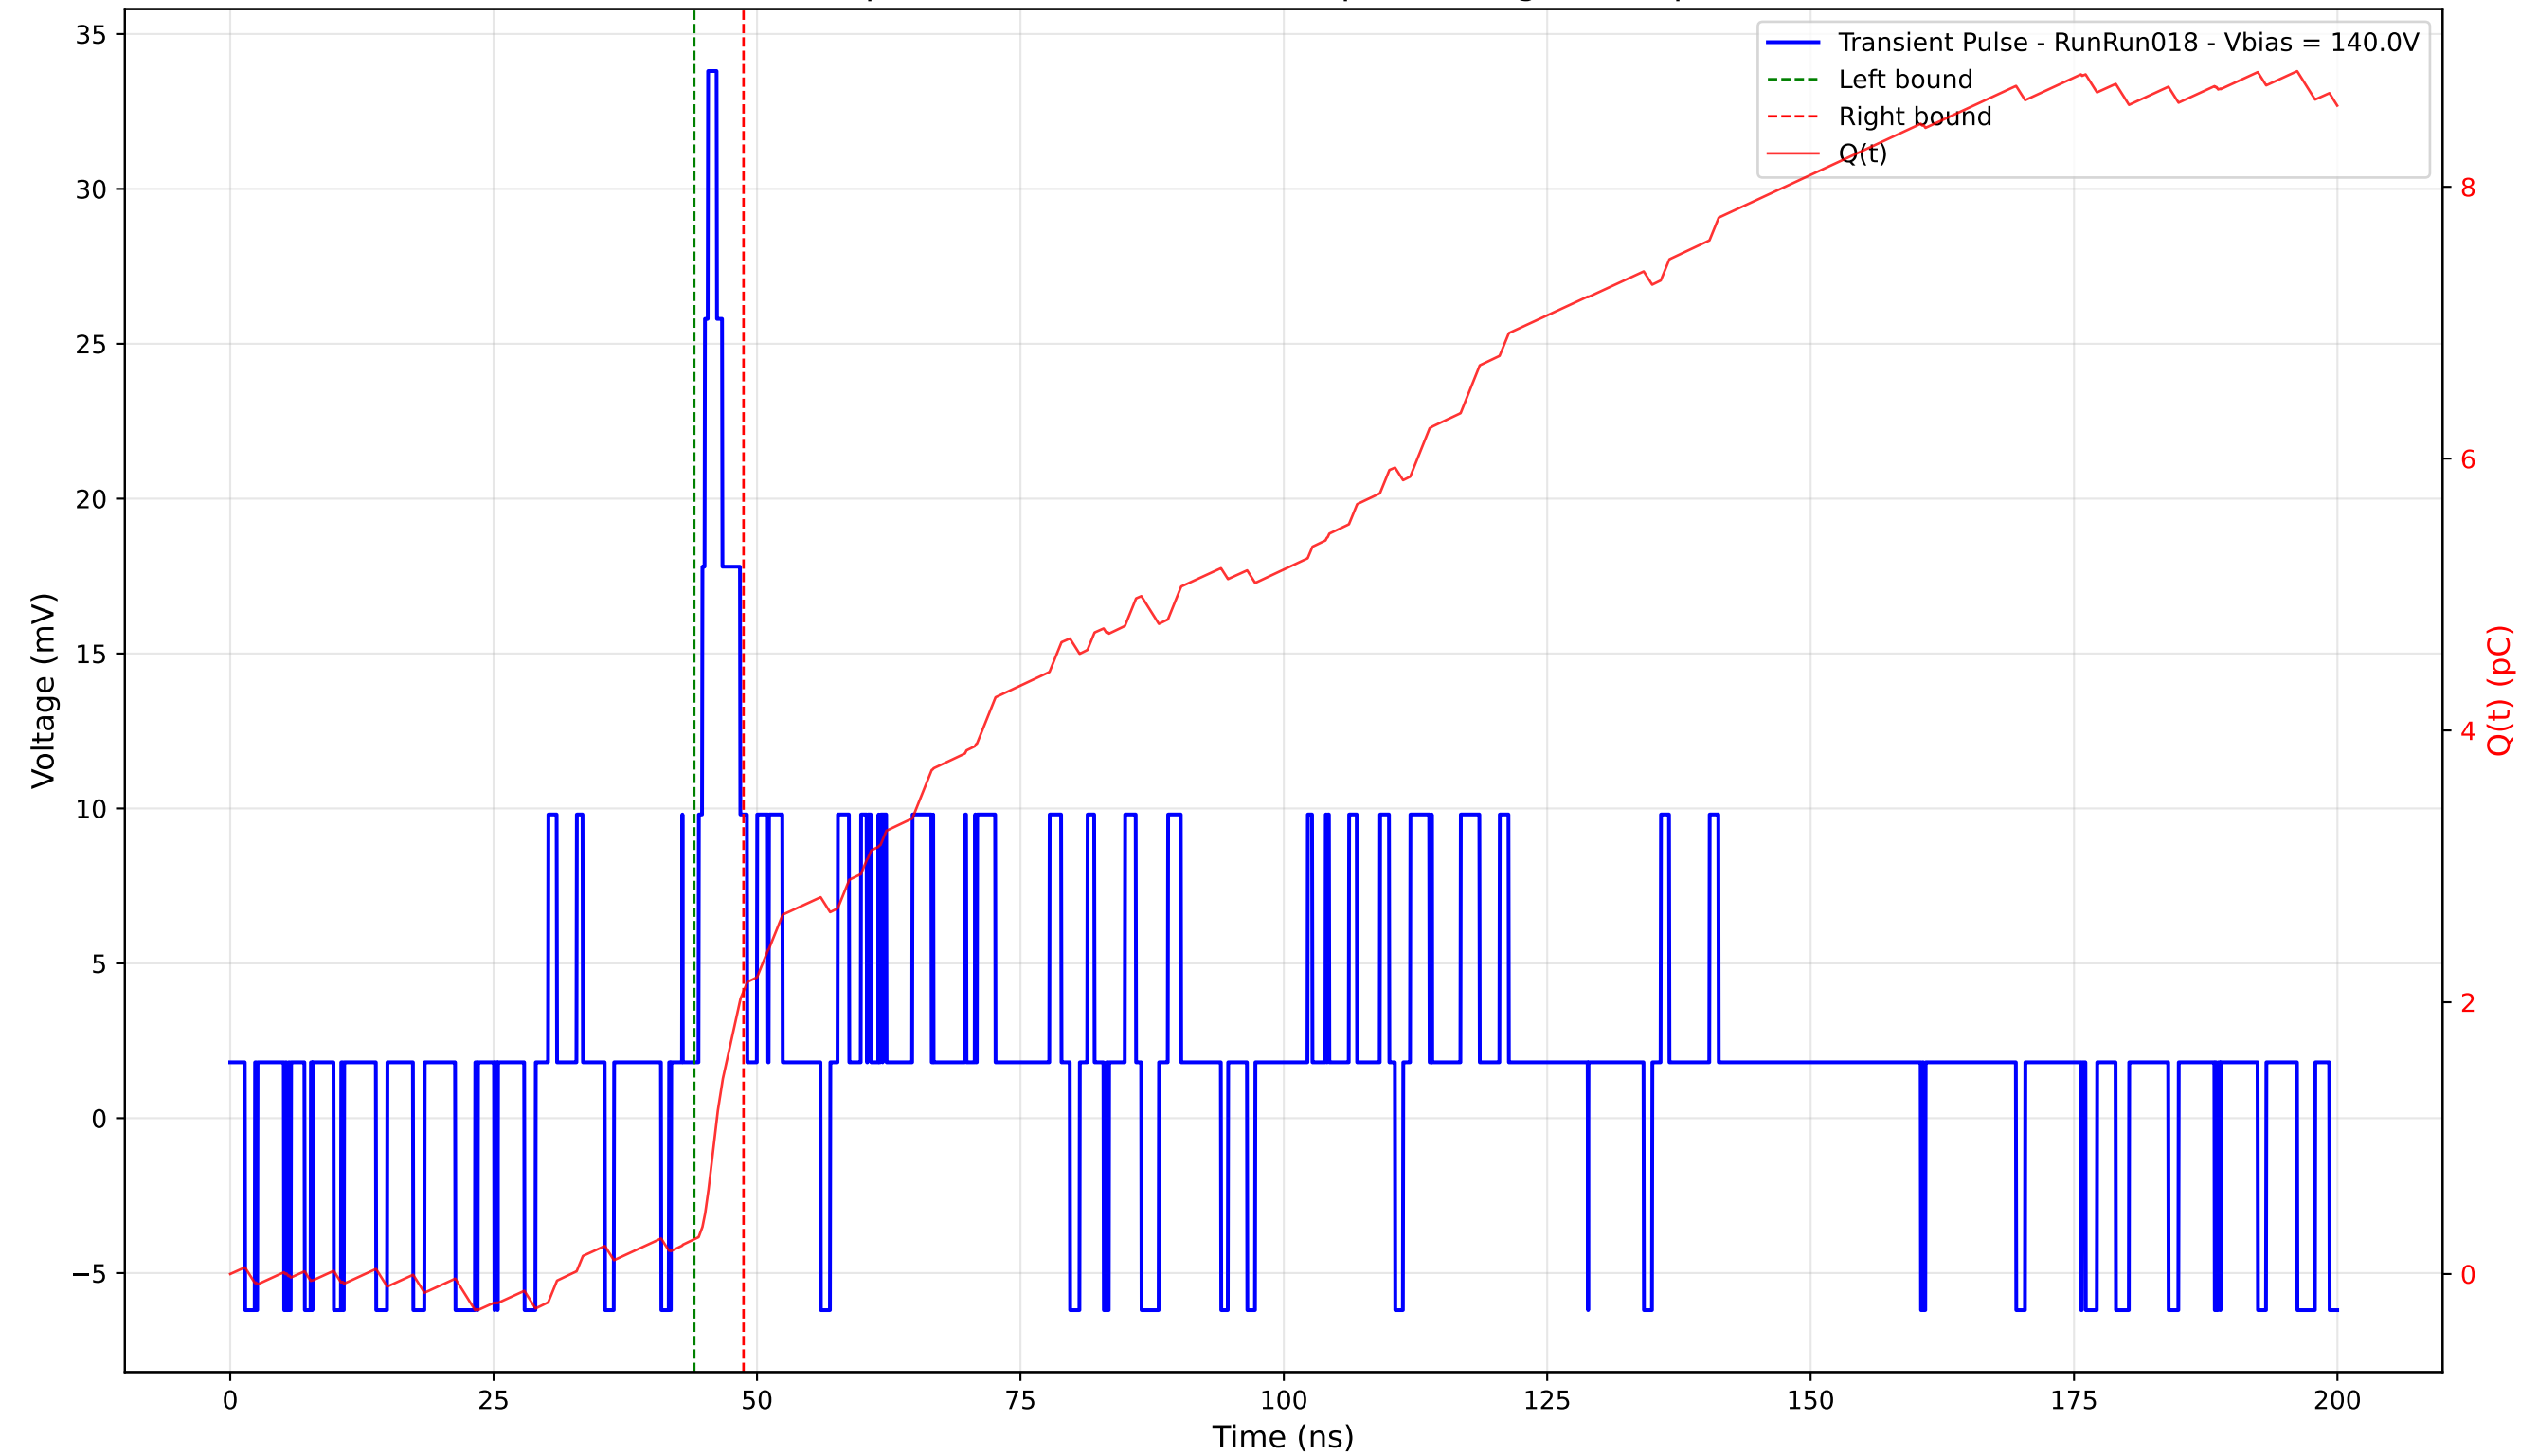


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 2.28 pC - Rise Time: 1.21 ns

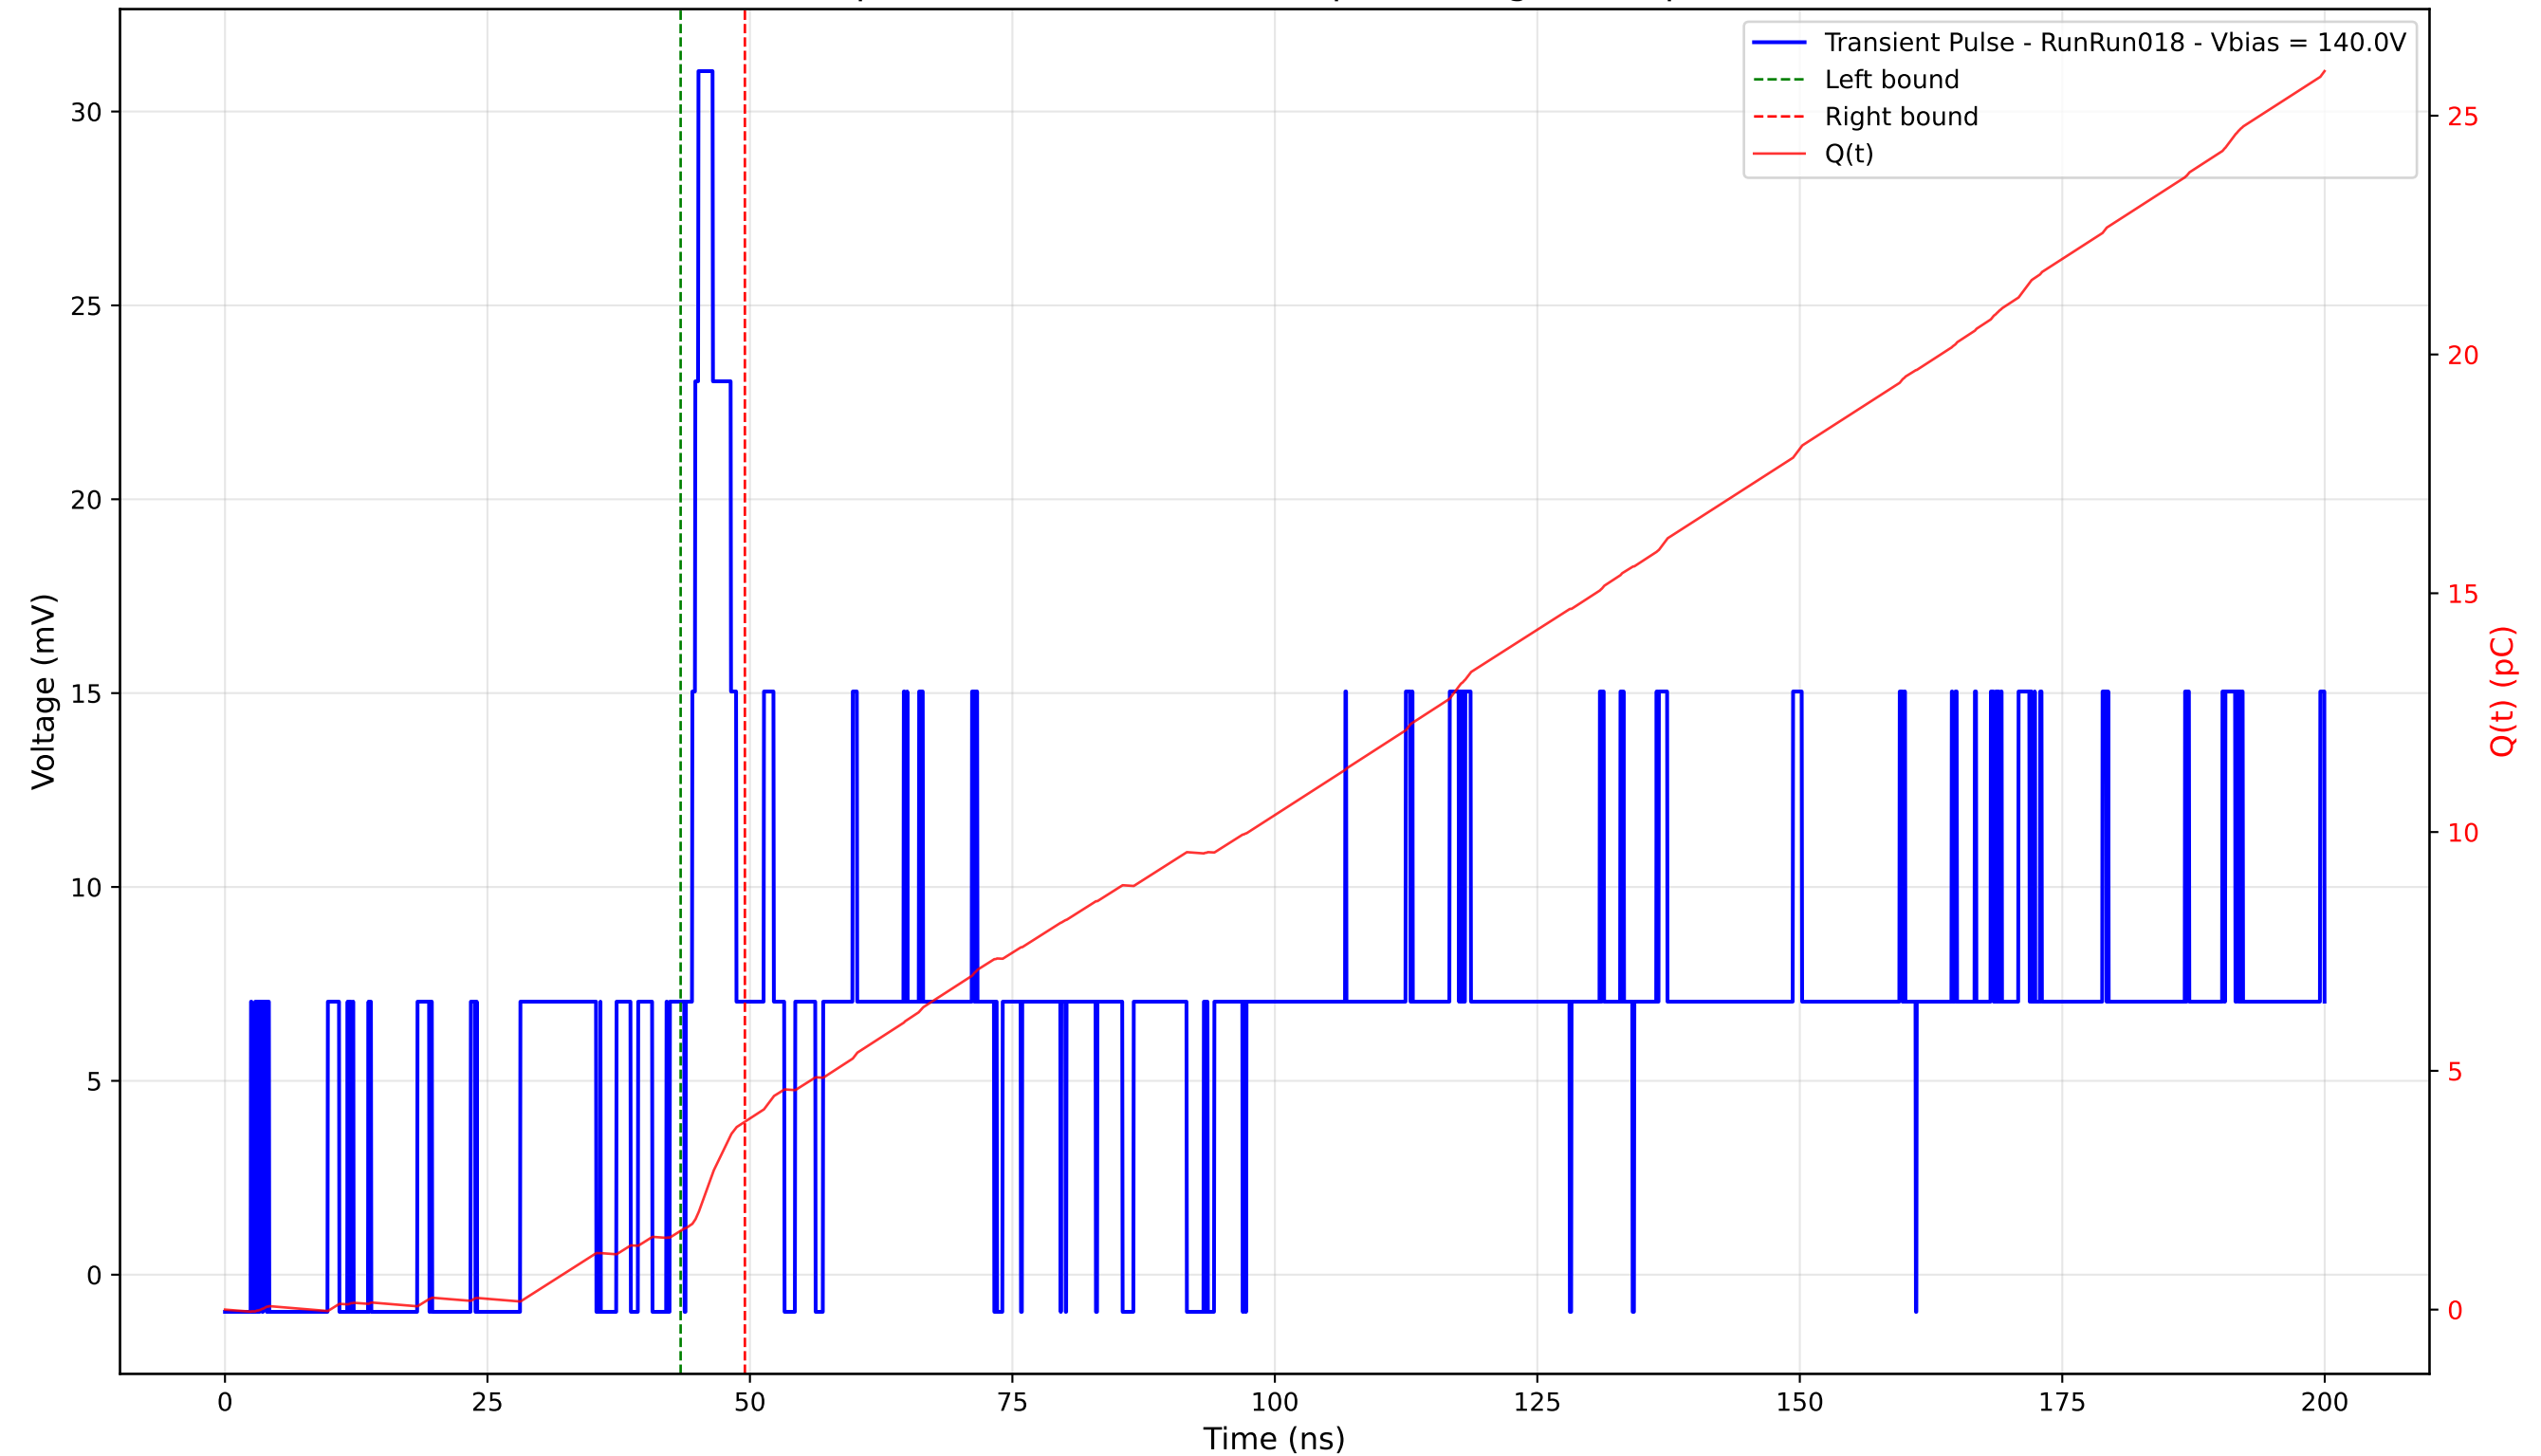


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 2.65 pC - Rise Time: 1.31 ns

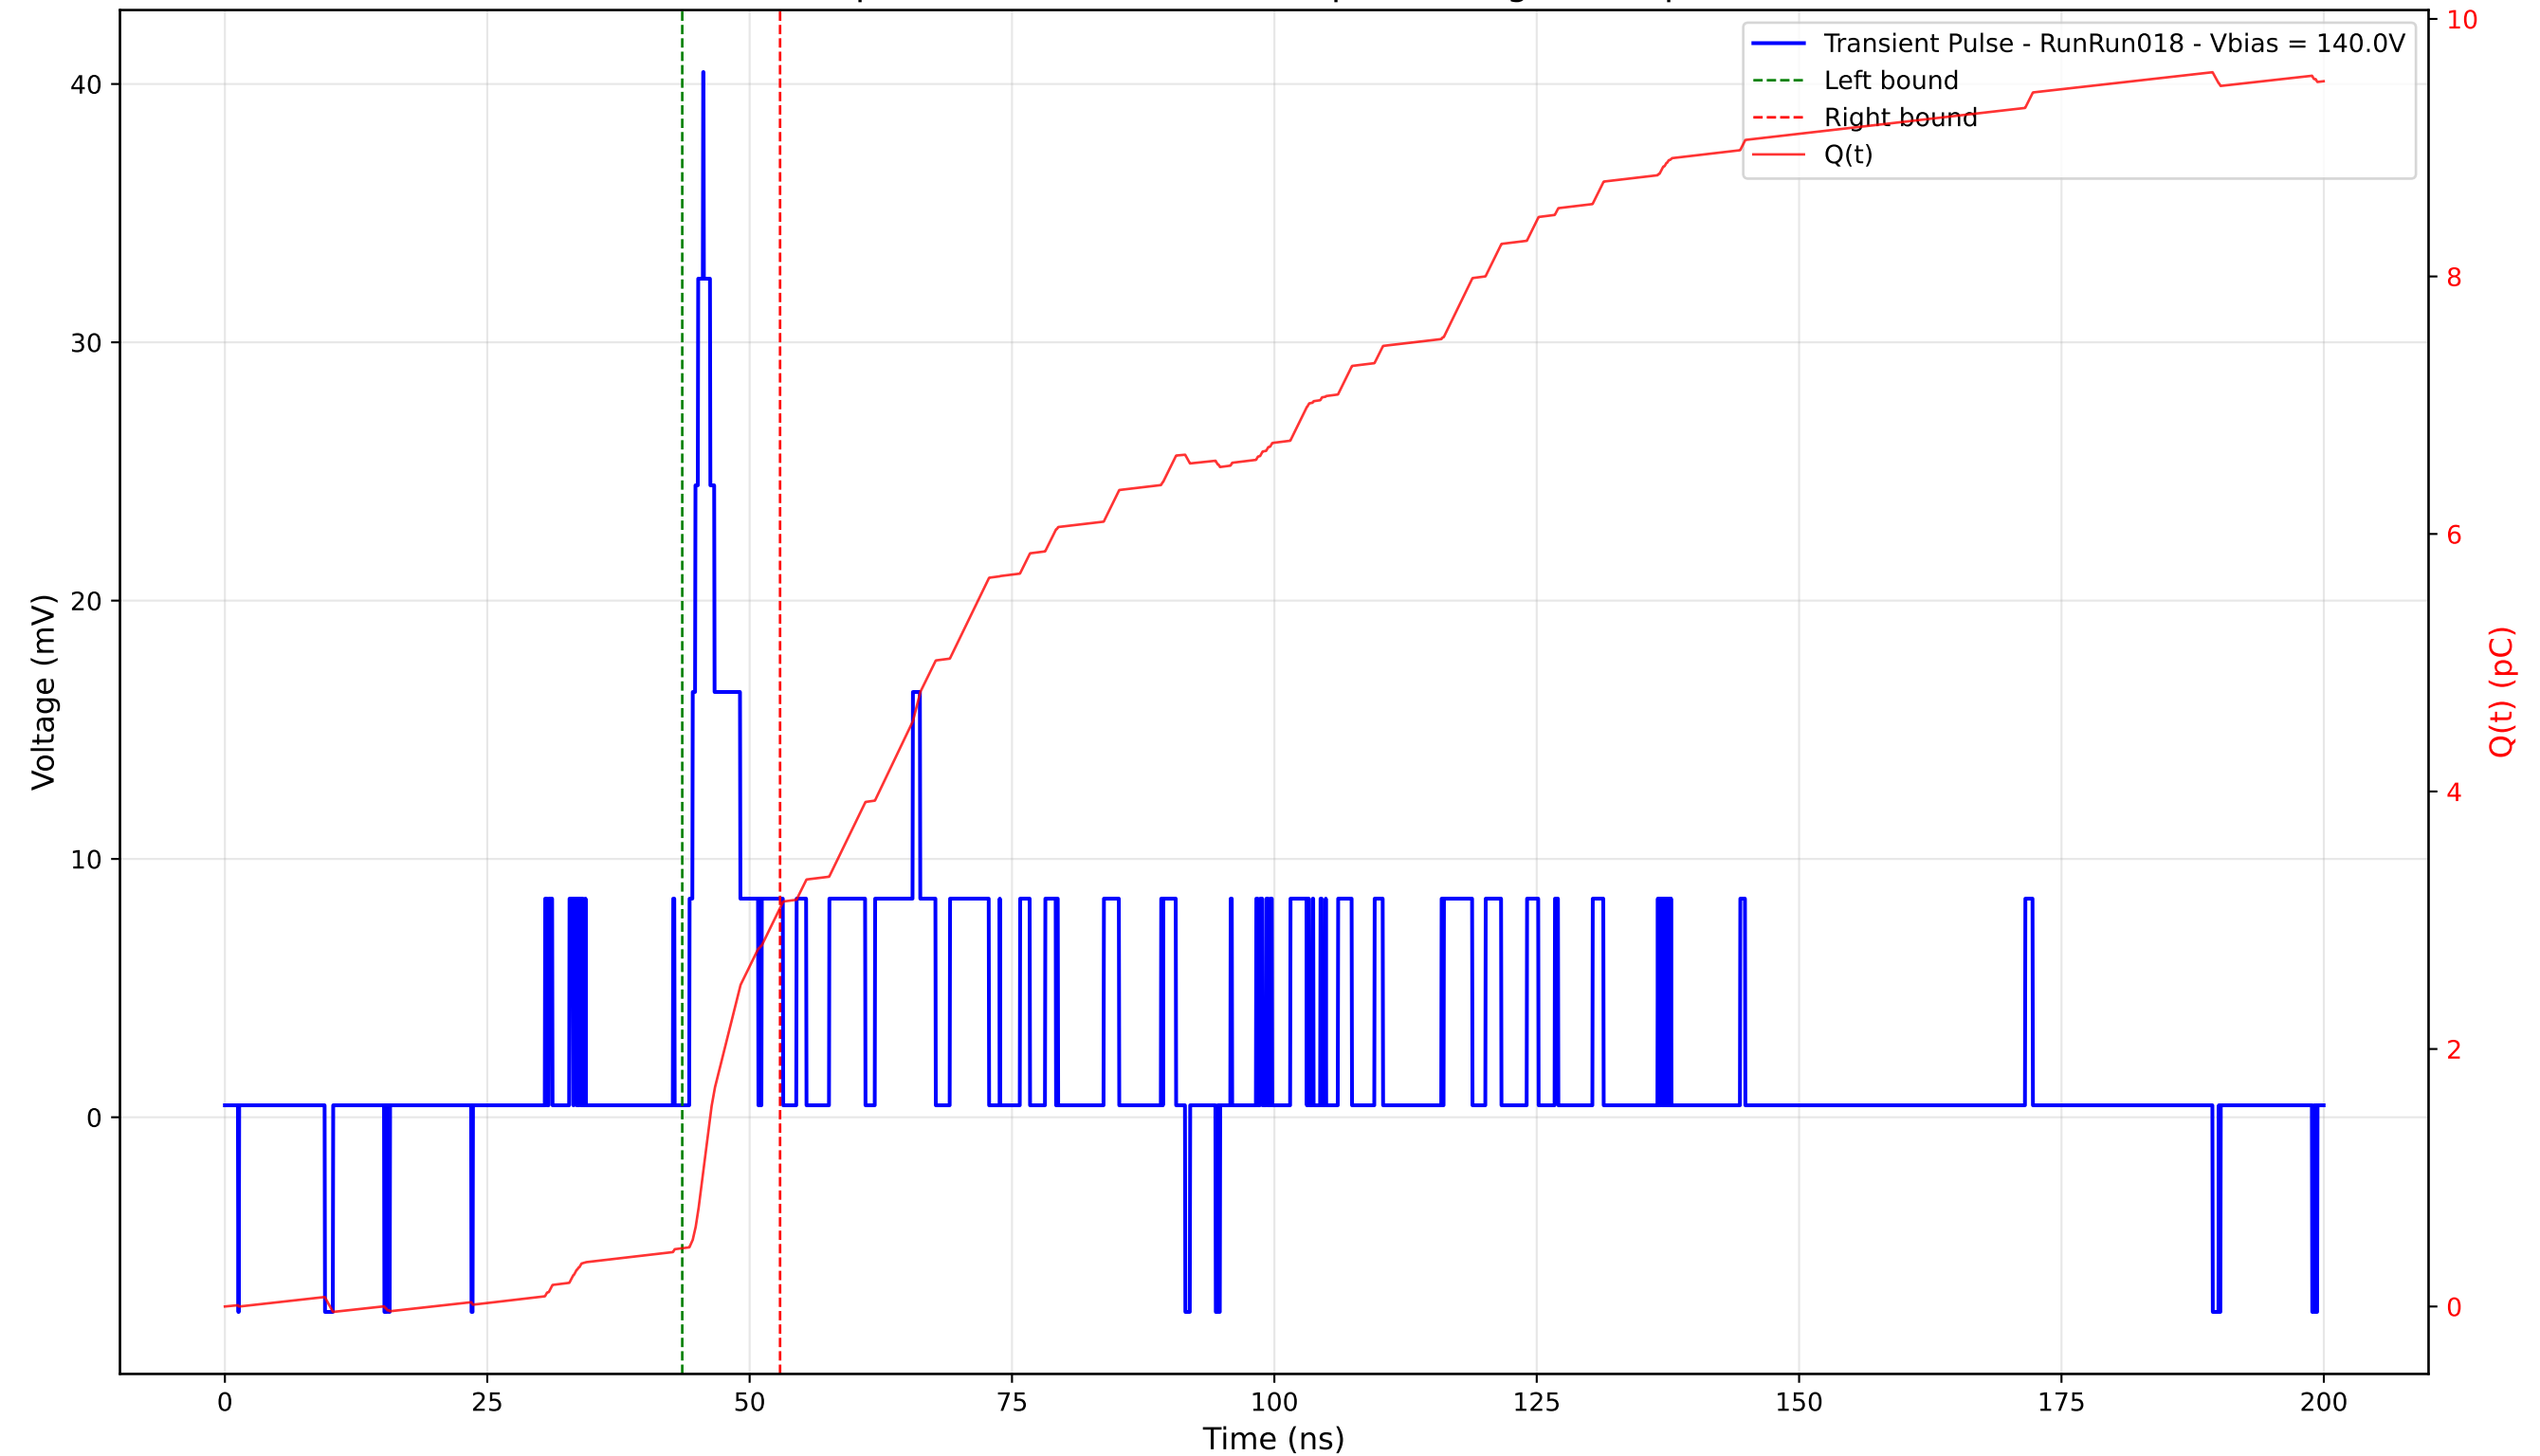


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 1.82 pC - Rise Time: 0.96 ns

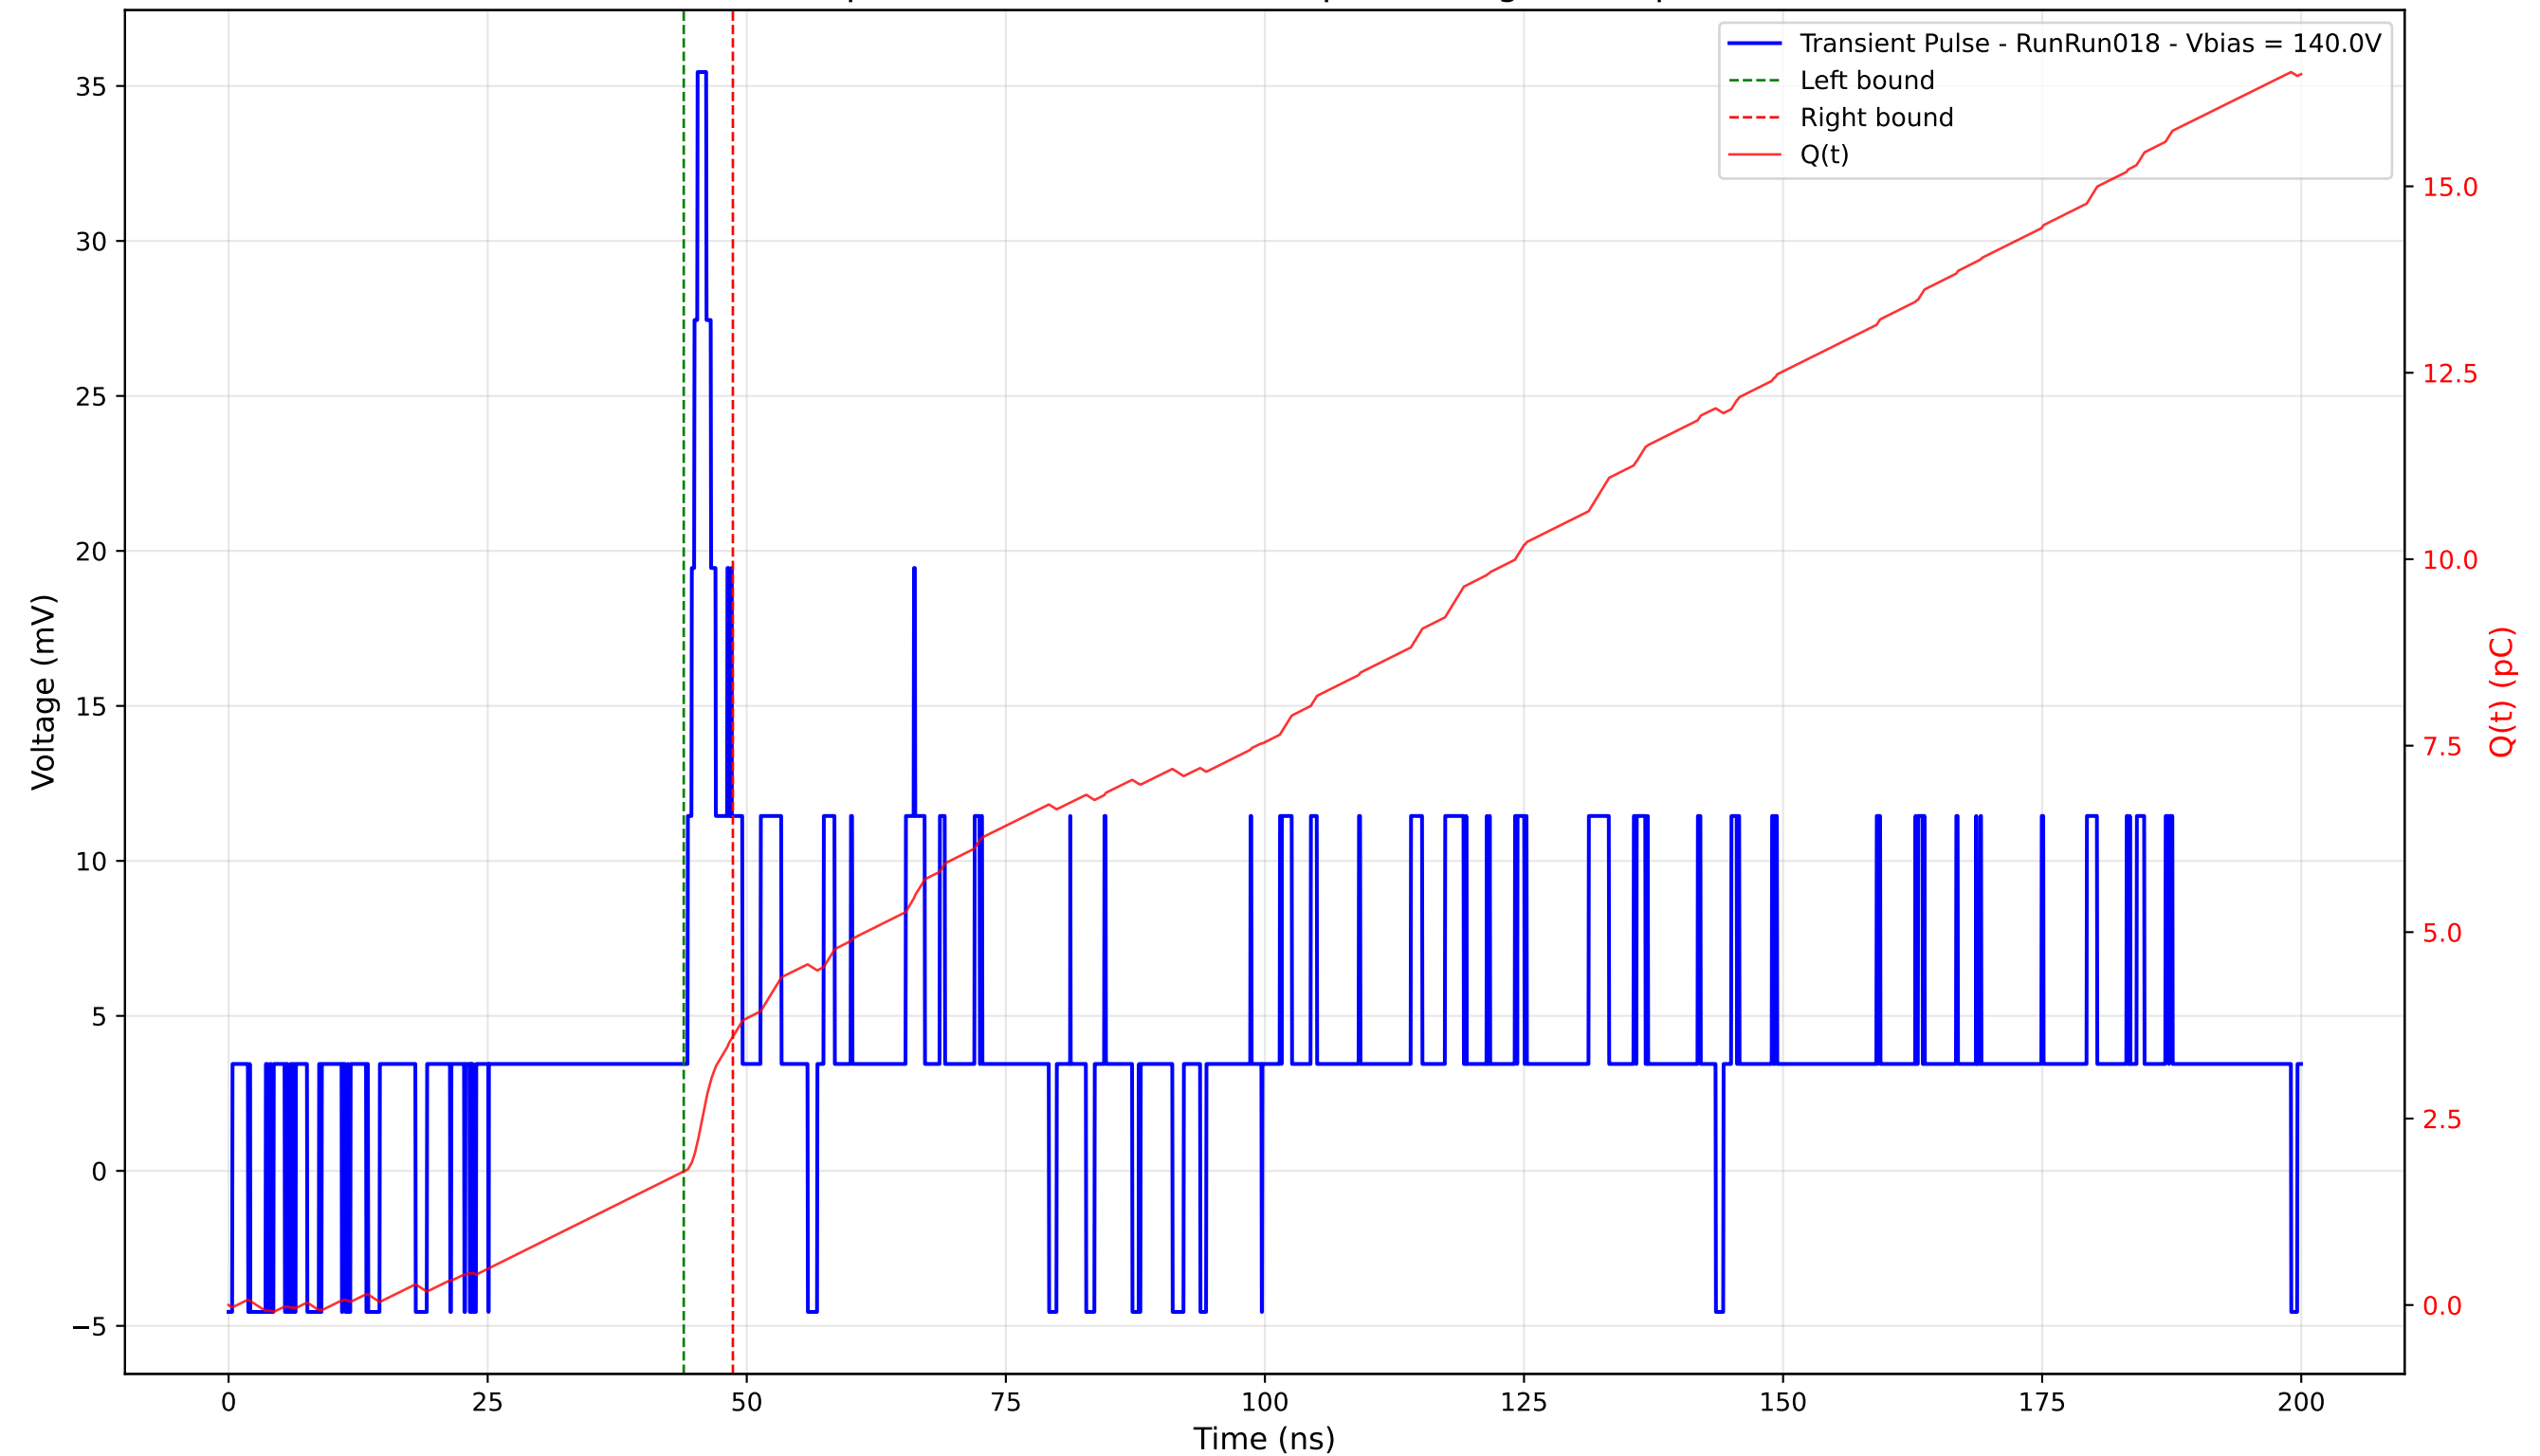


Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 1.78 pC - Rise Time: 0.80 ns

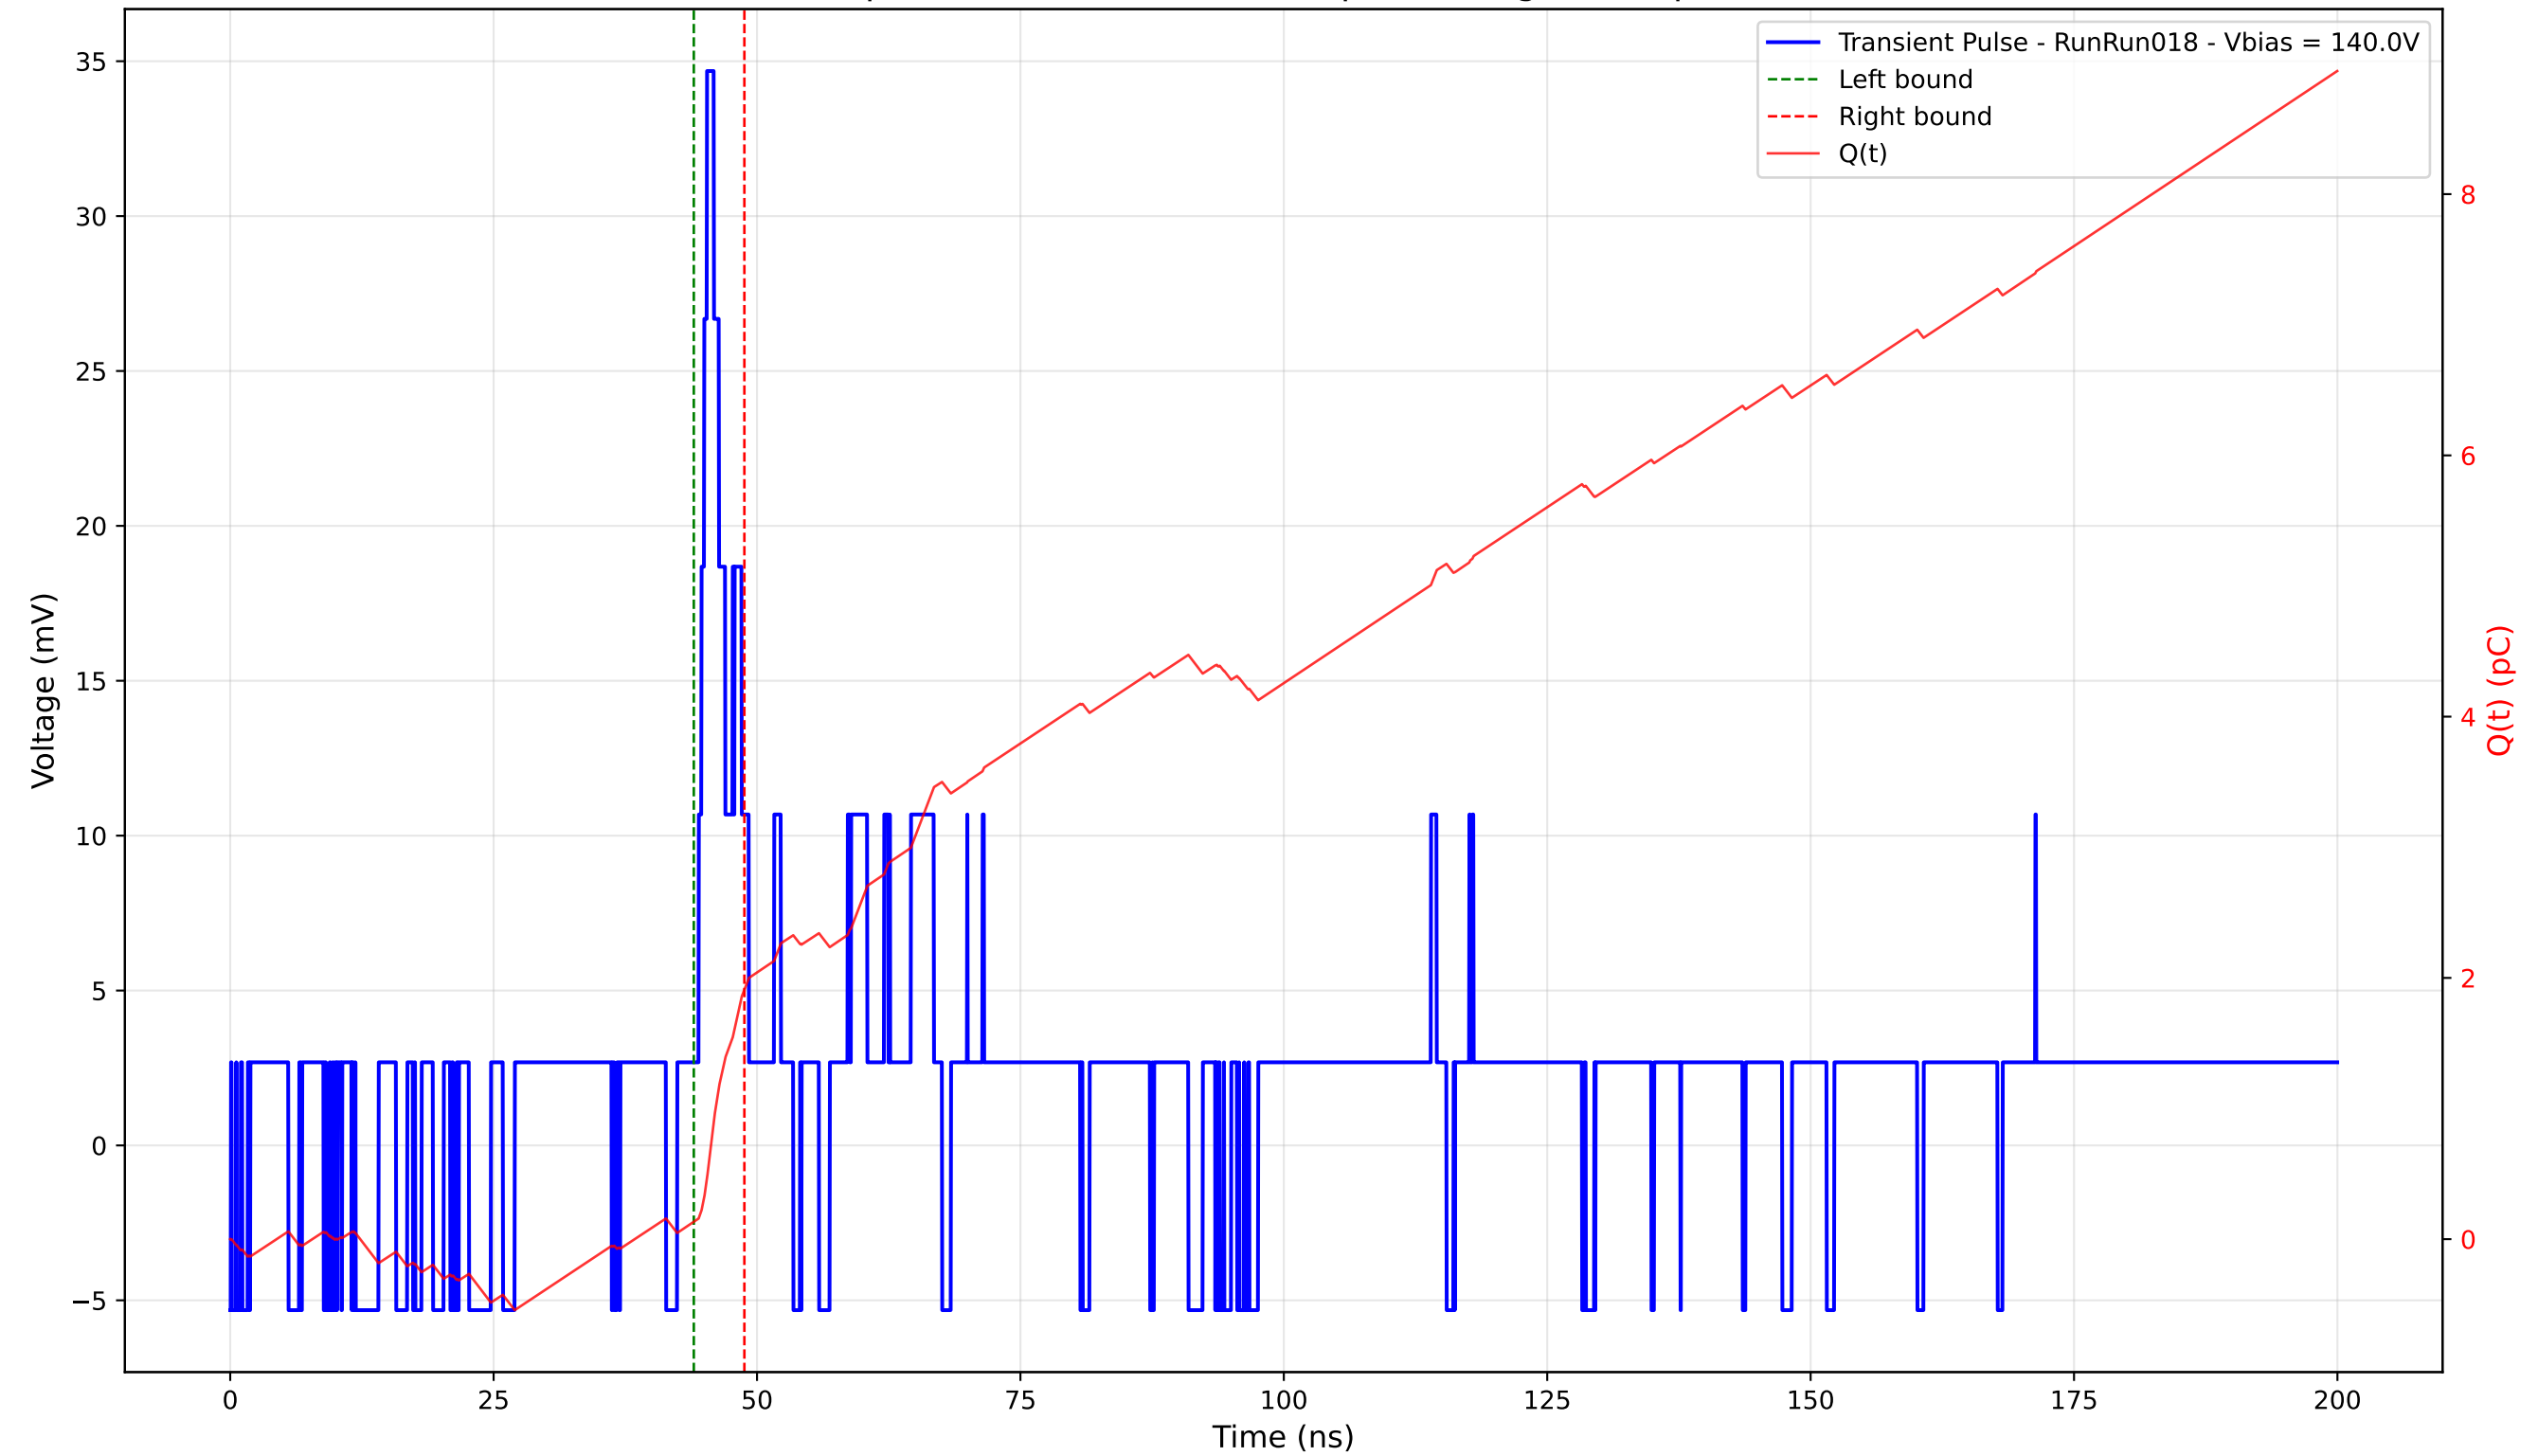


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 1.71 pC - Rise Time: 1.06 ns

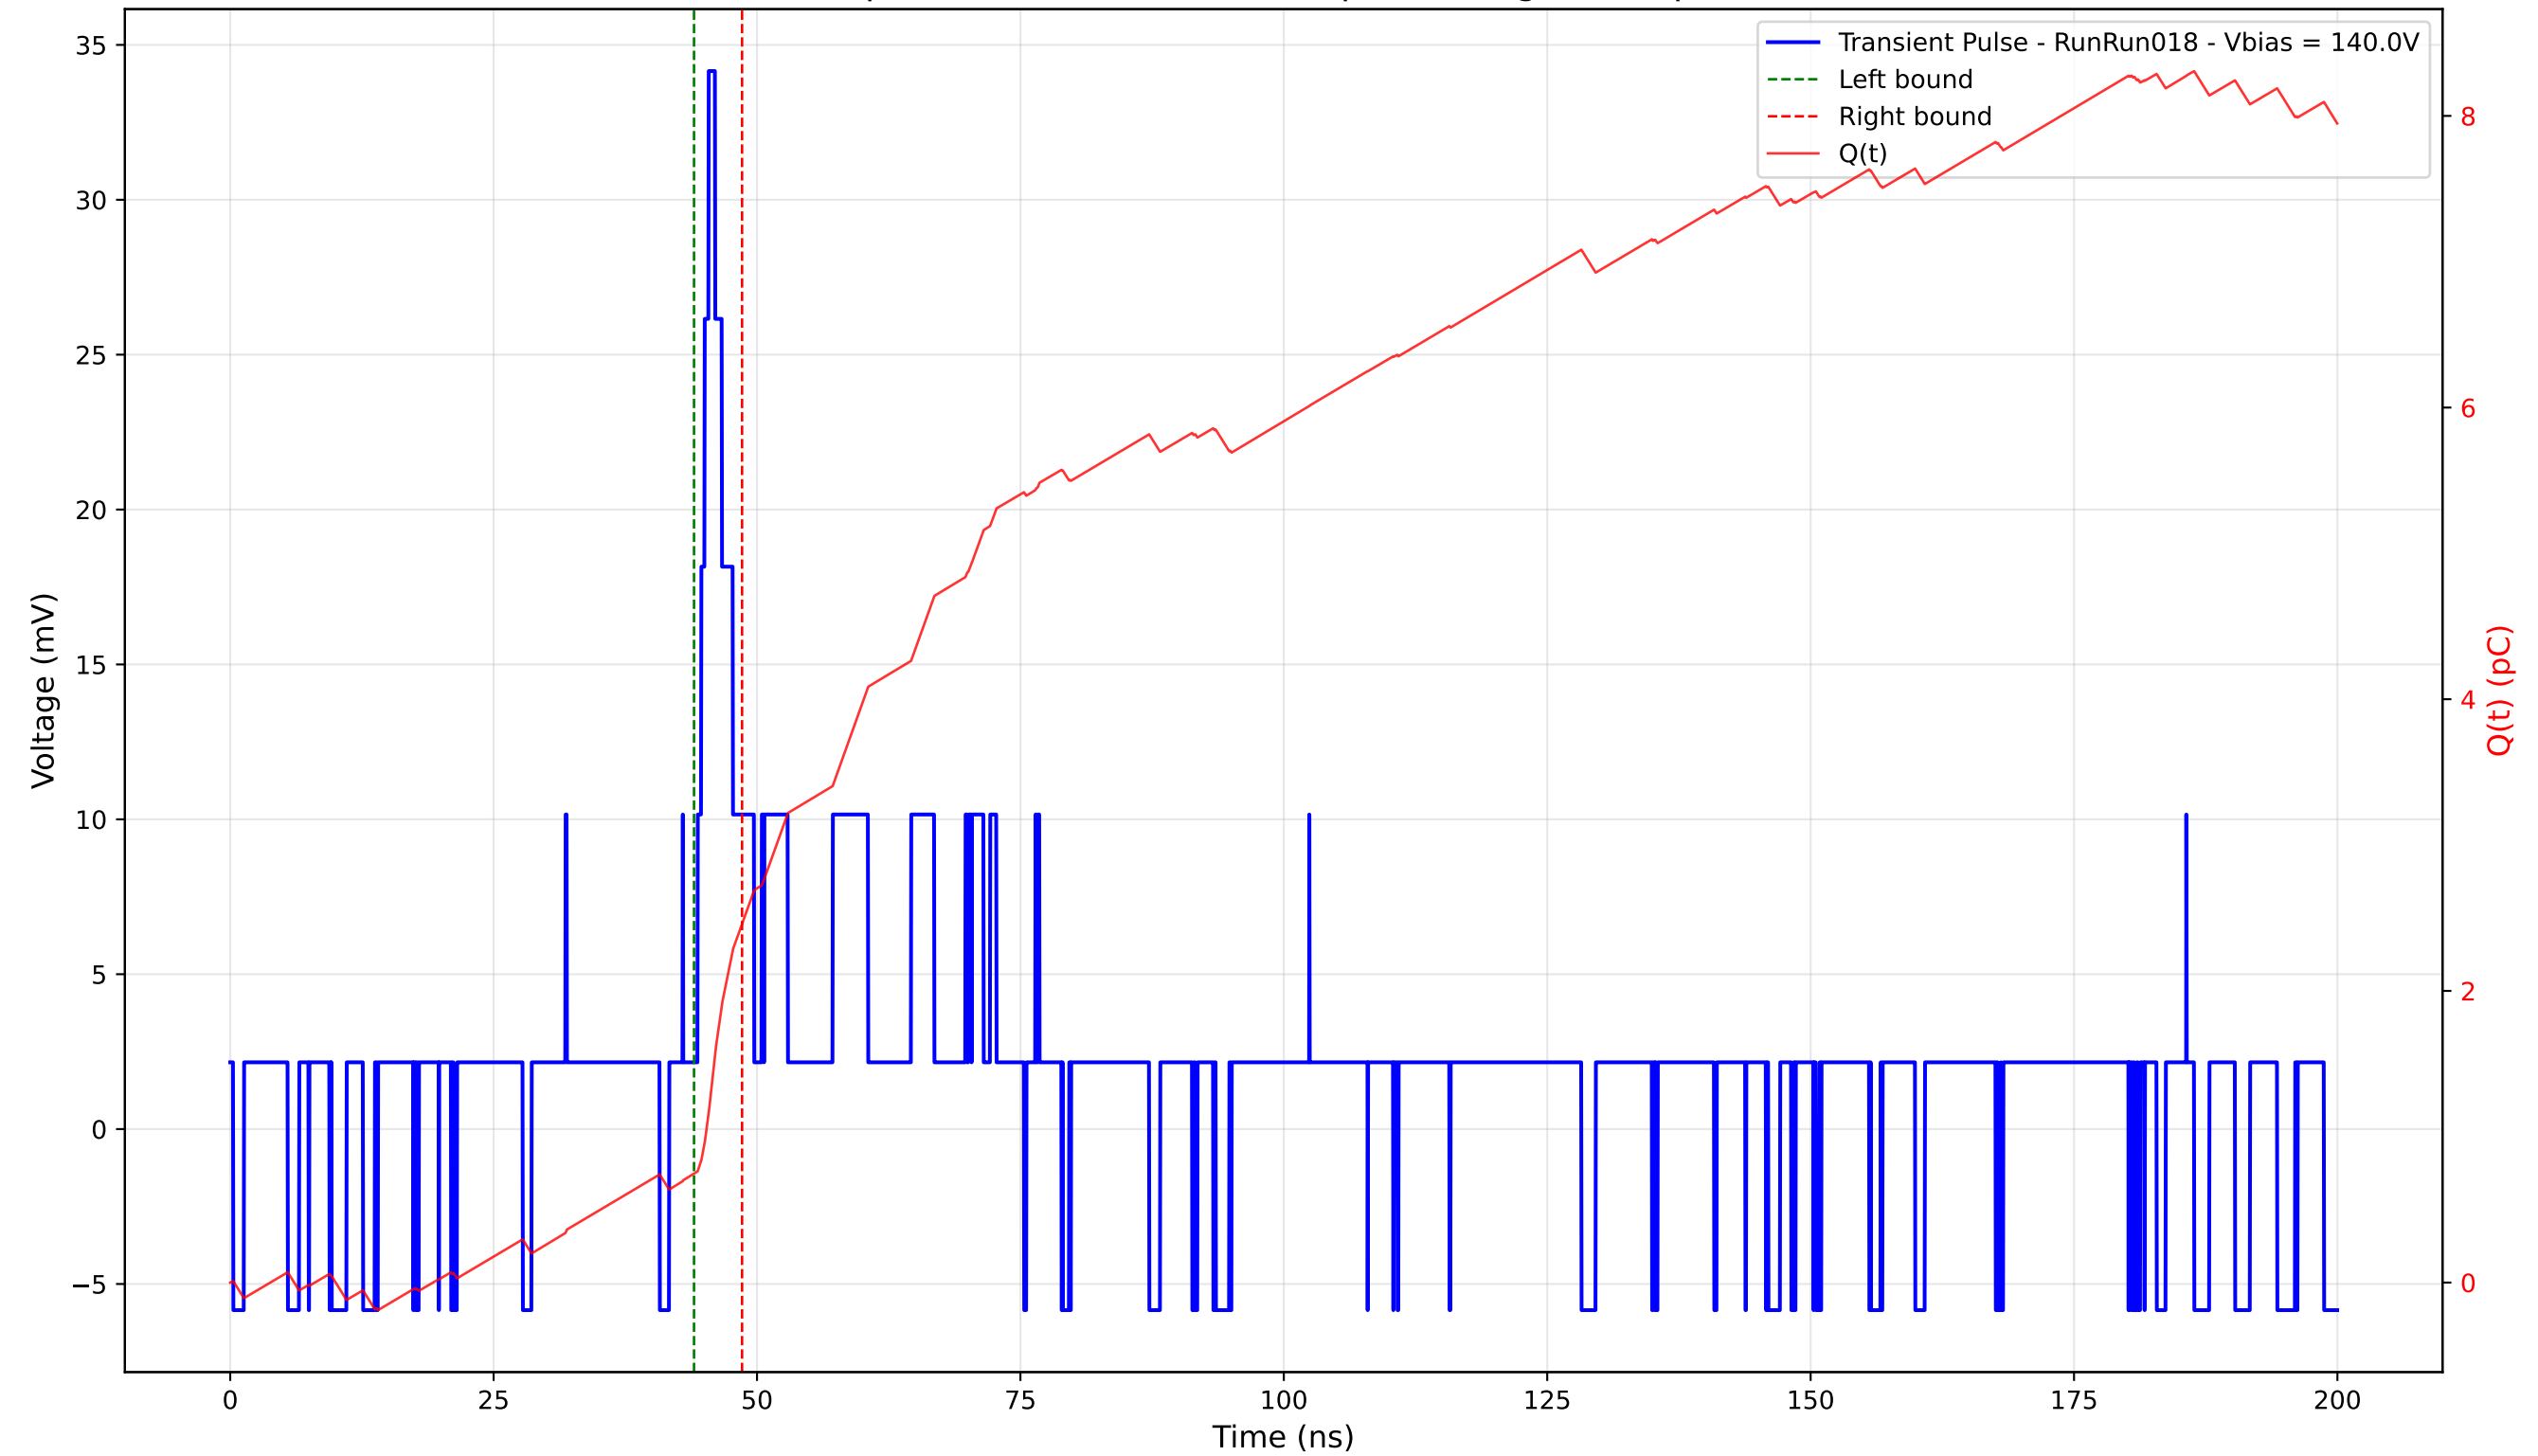


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 2.19 pC - Rise Time: 1.03 ns

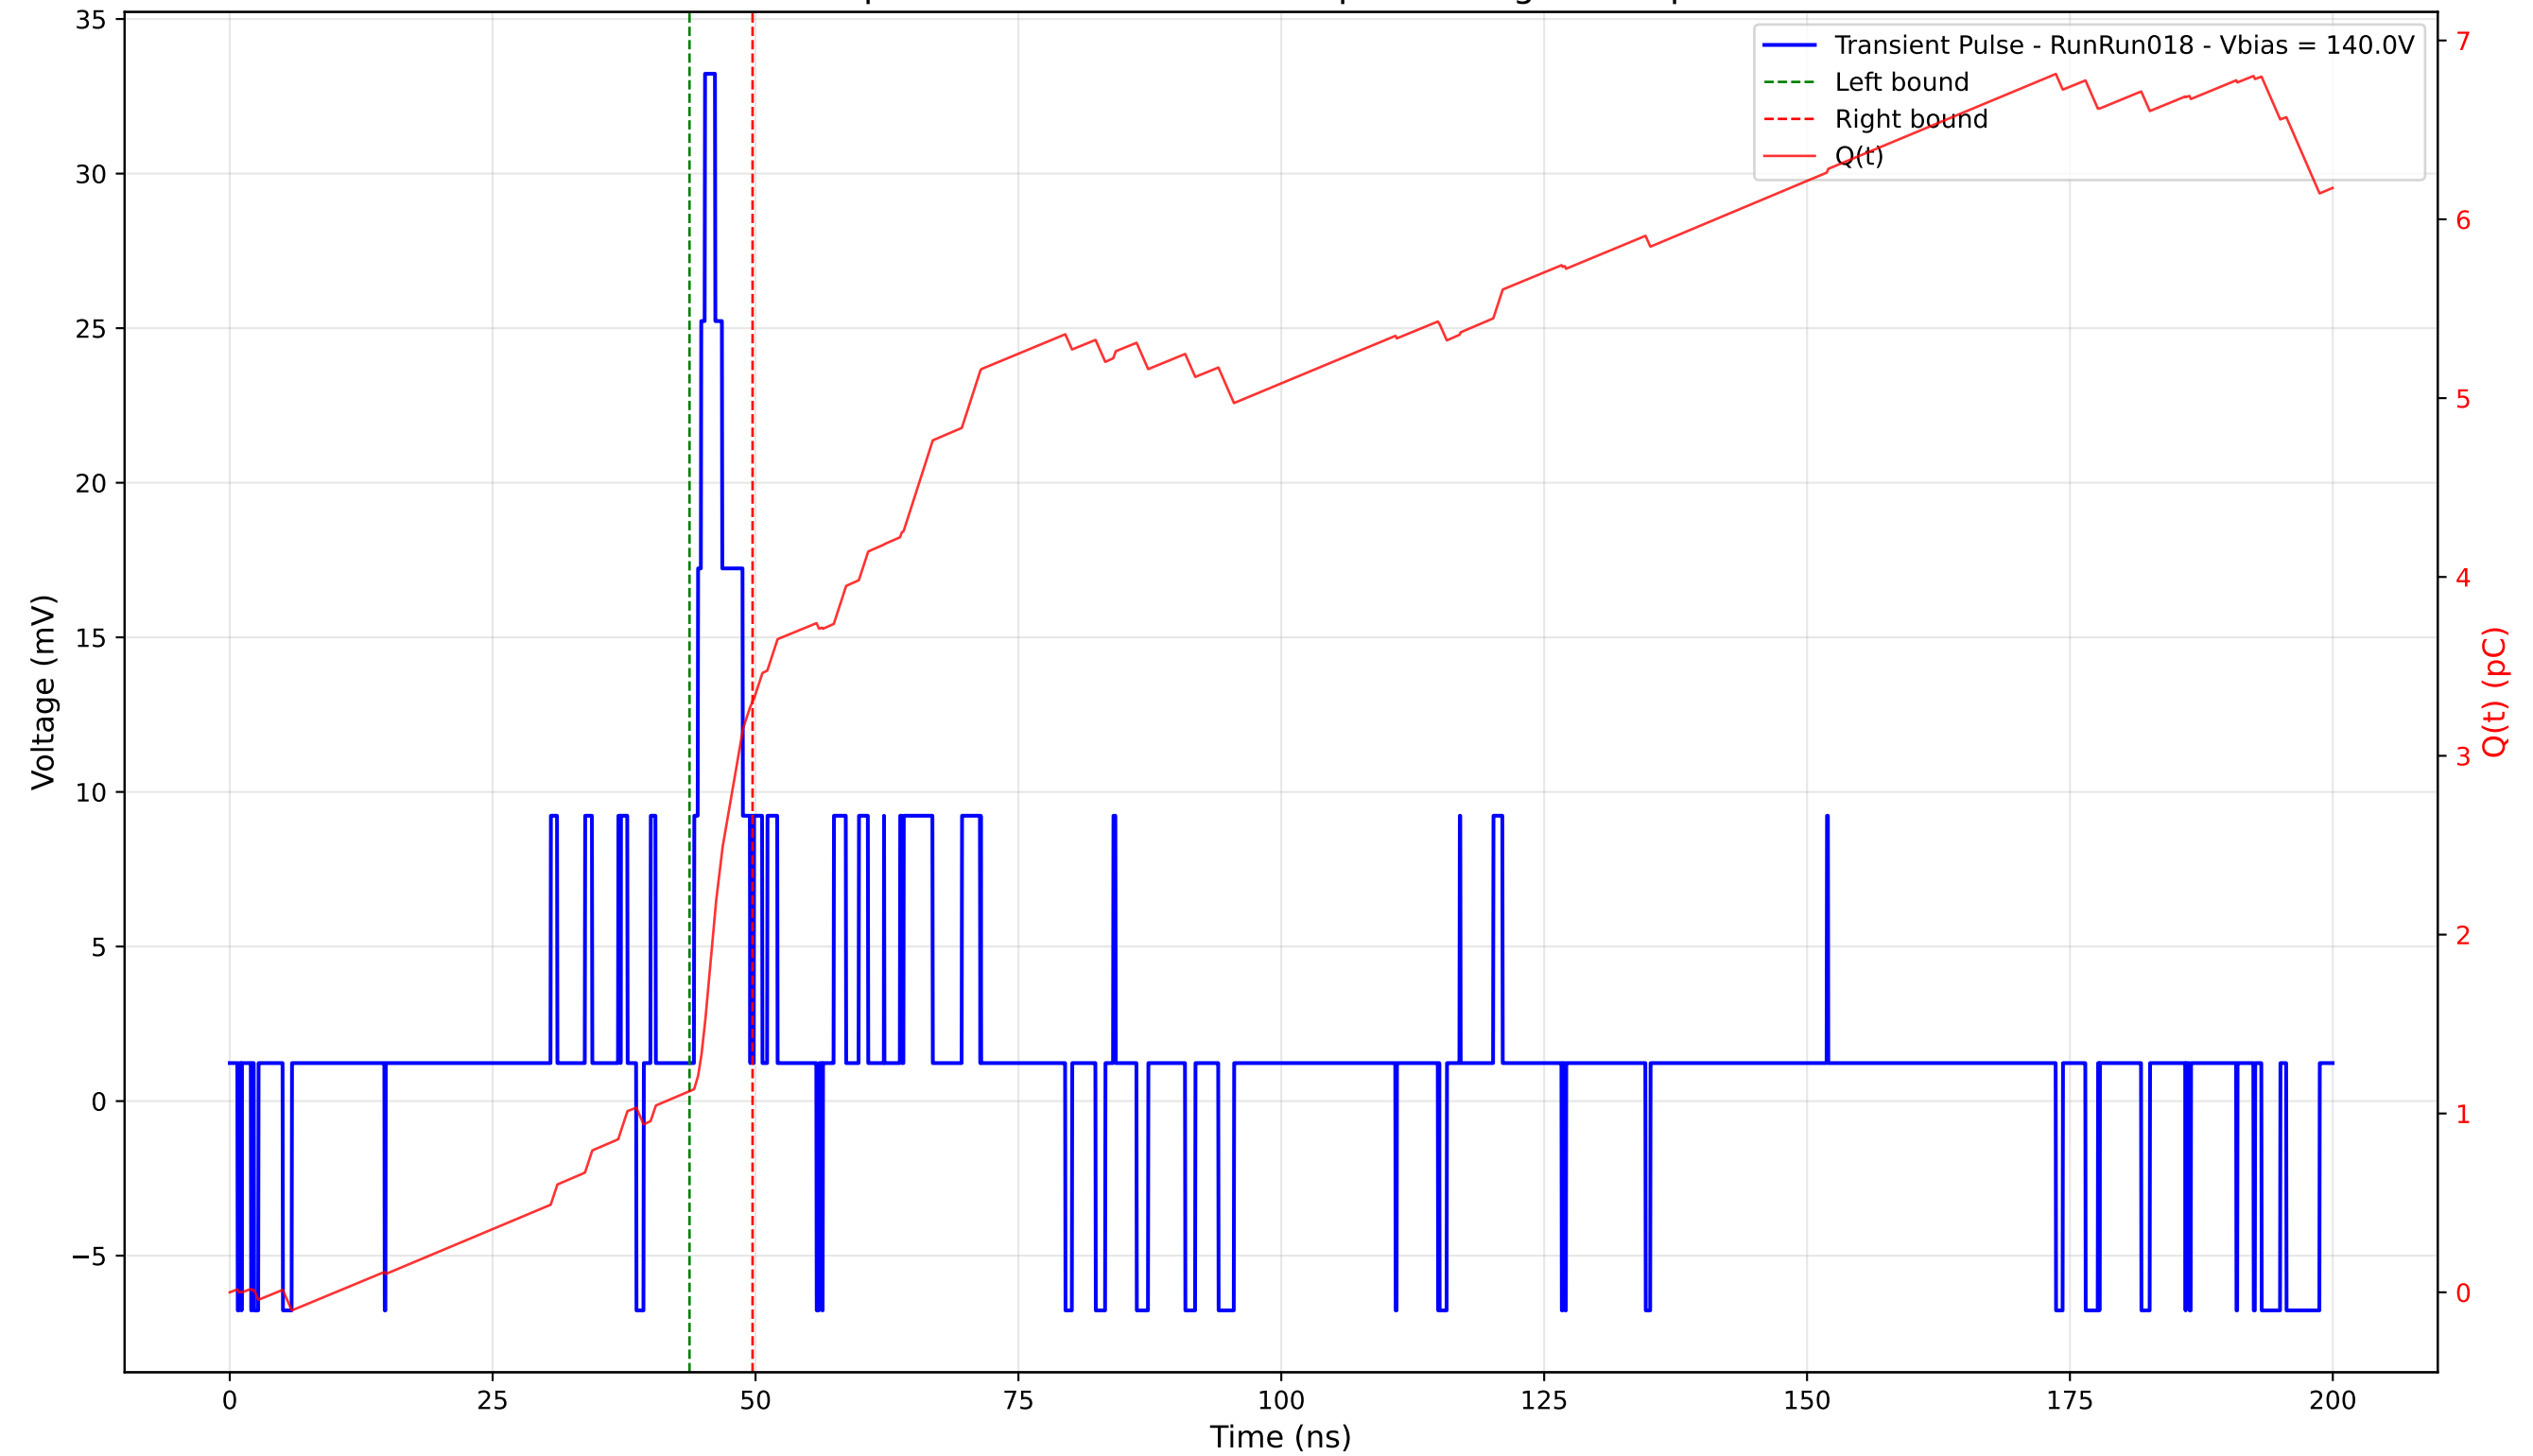


Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 1.88 pC - Rise Time: 0.00 ns (N/A)

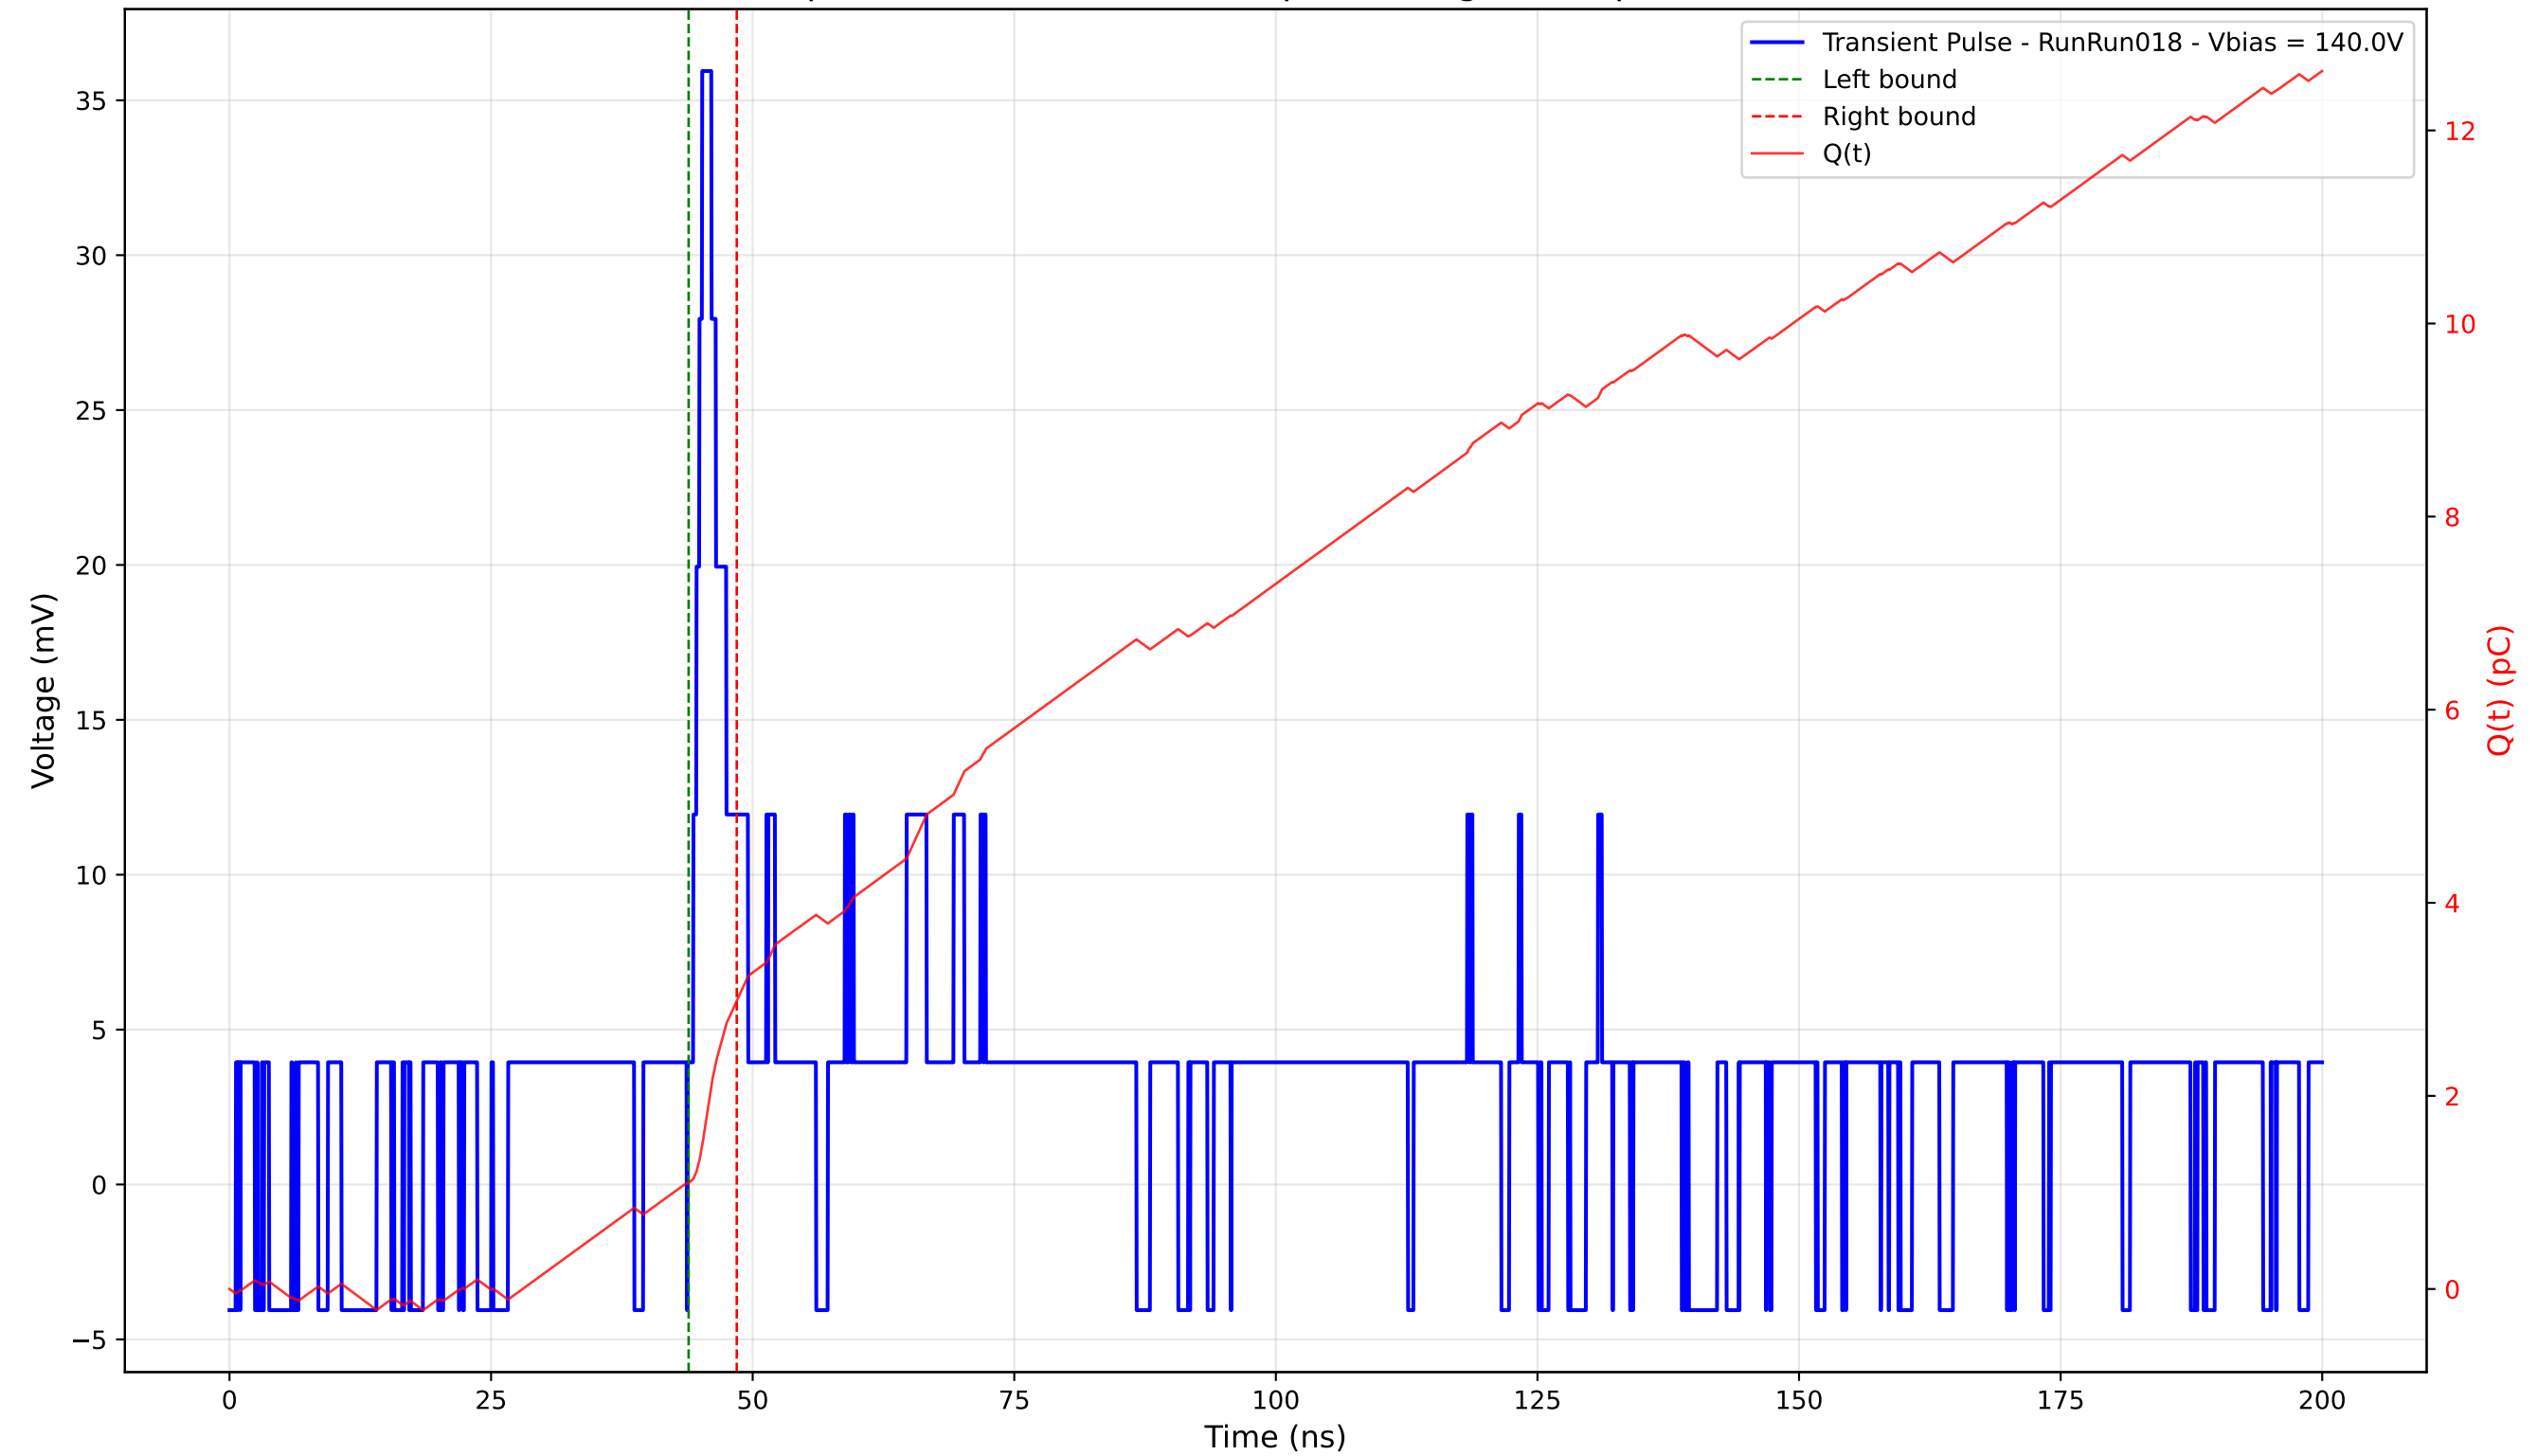


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 2.33 pC - Rise Time: 0.85 ns

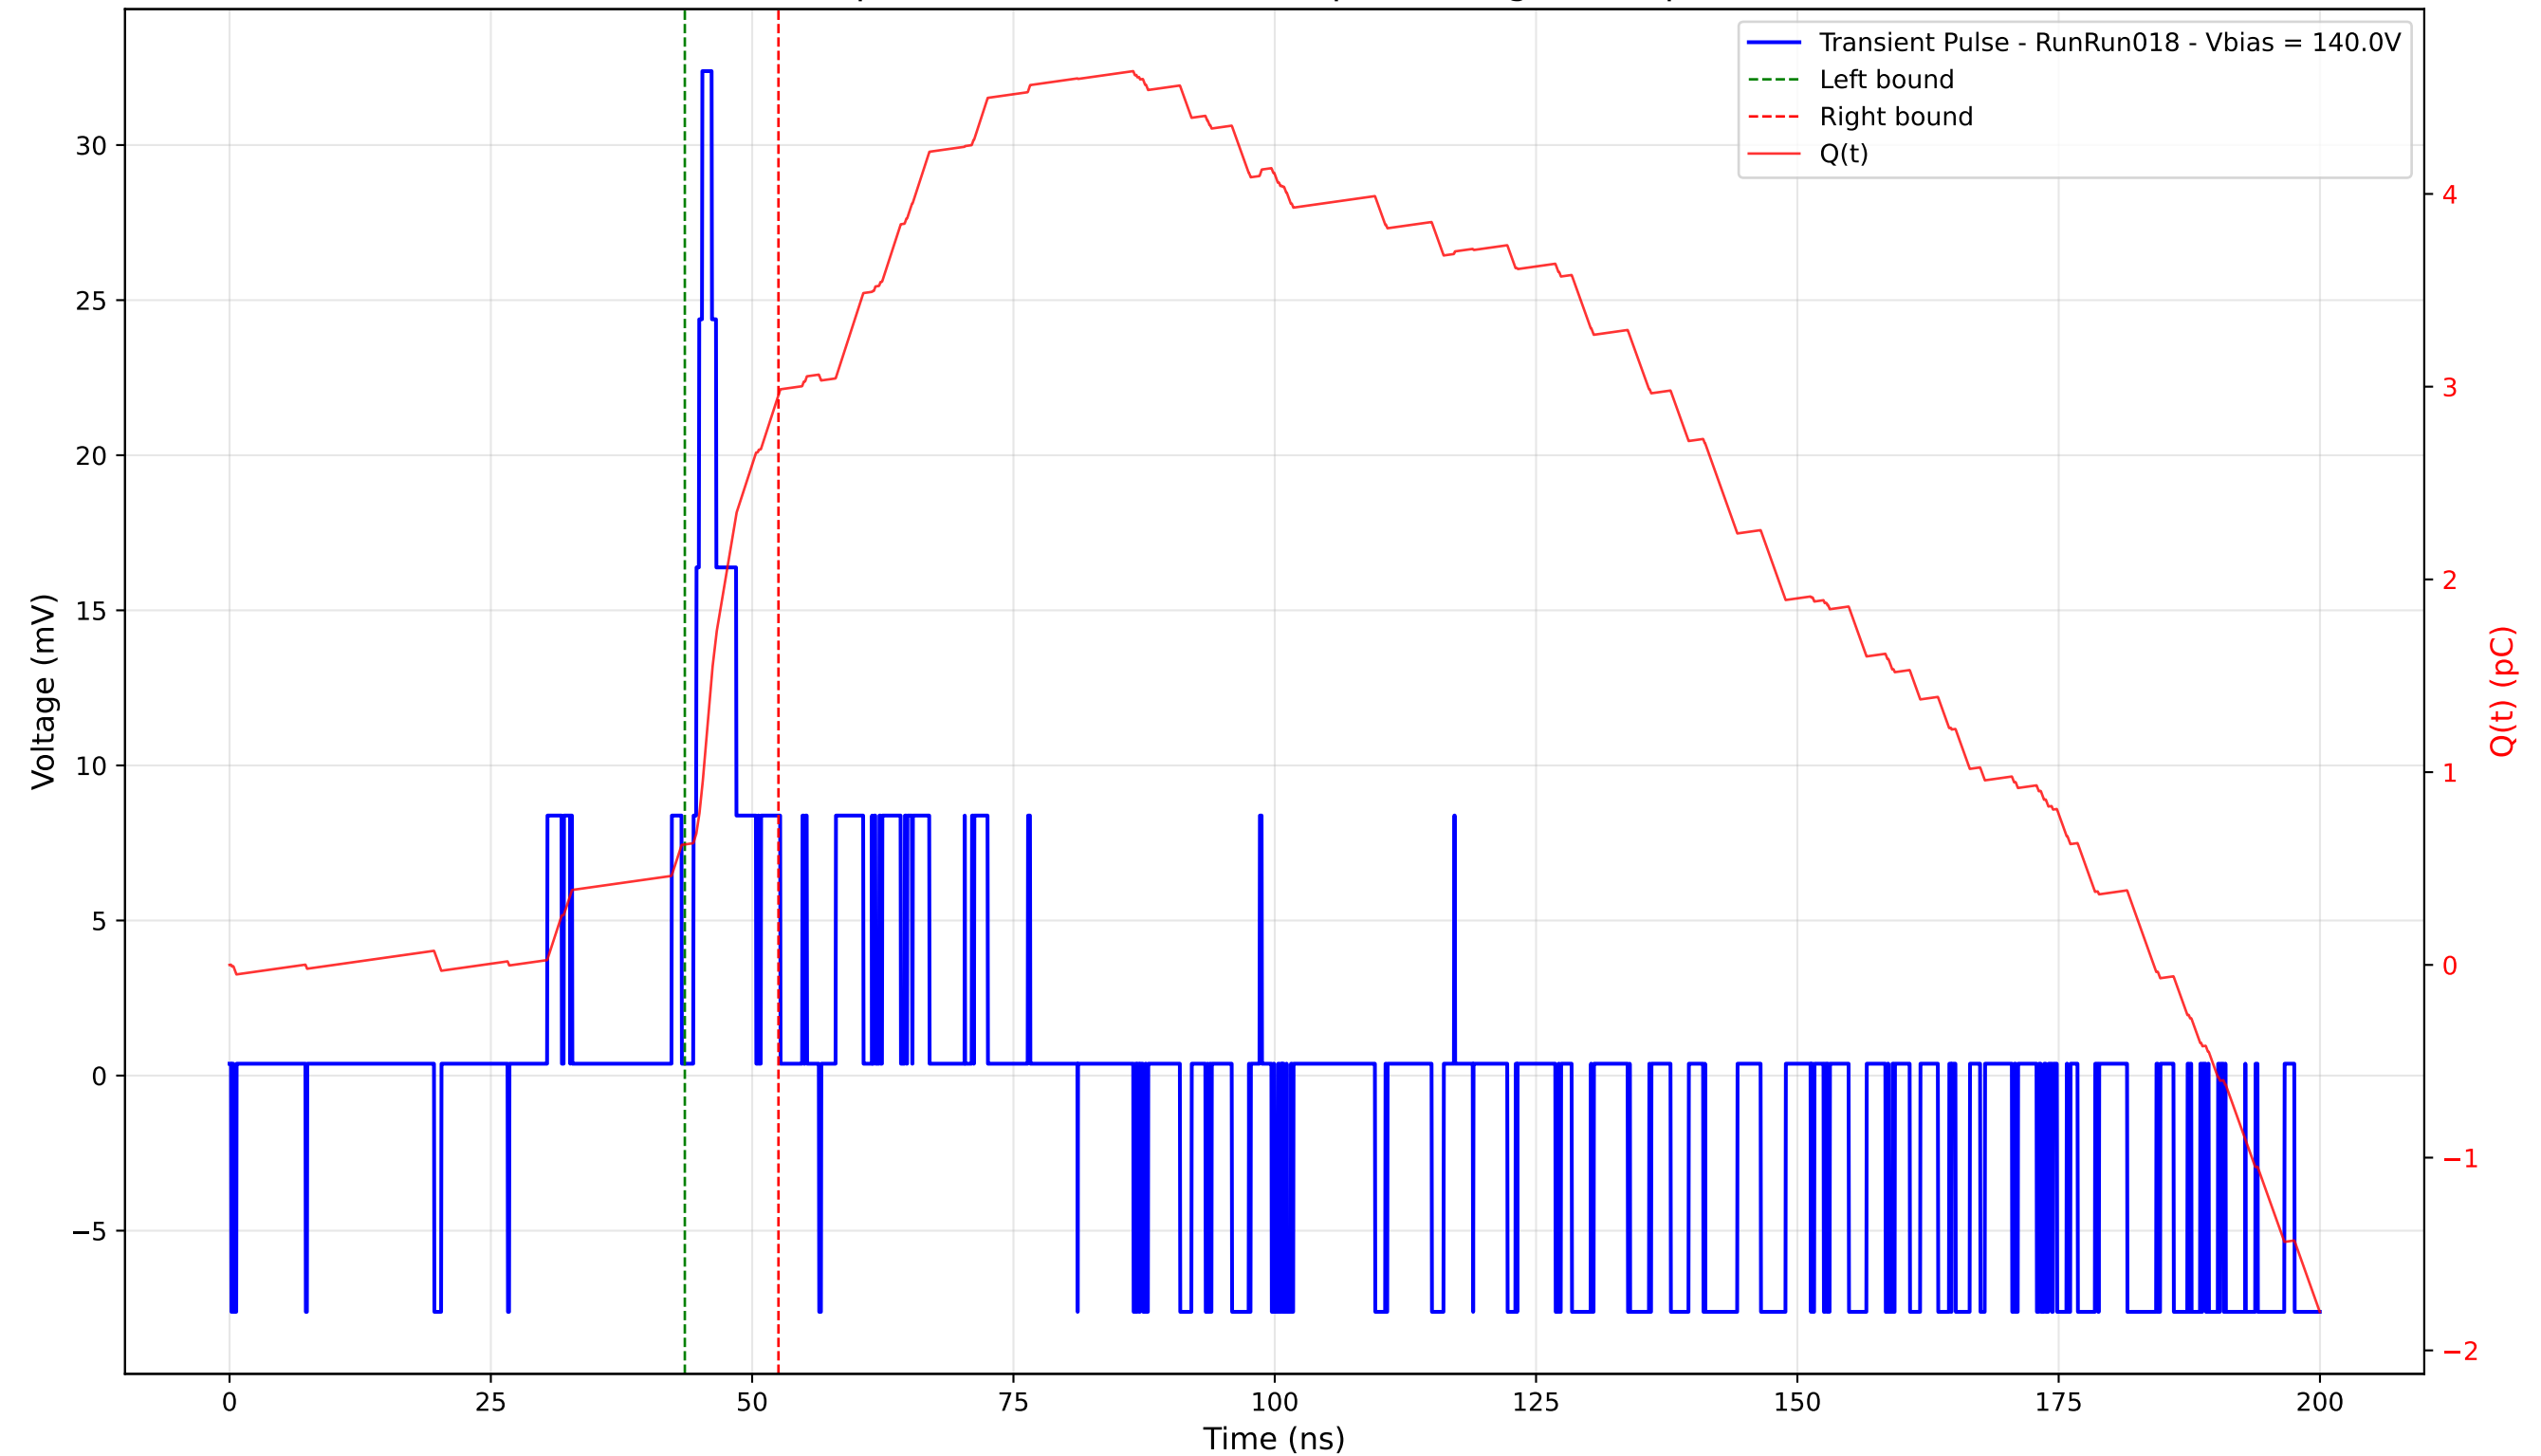


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 2.28 pC - Rise Time: 1.23 ns

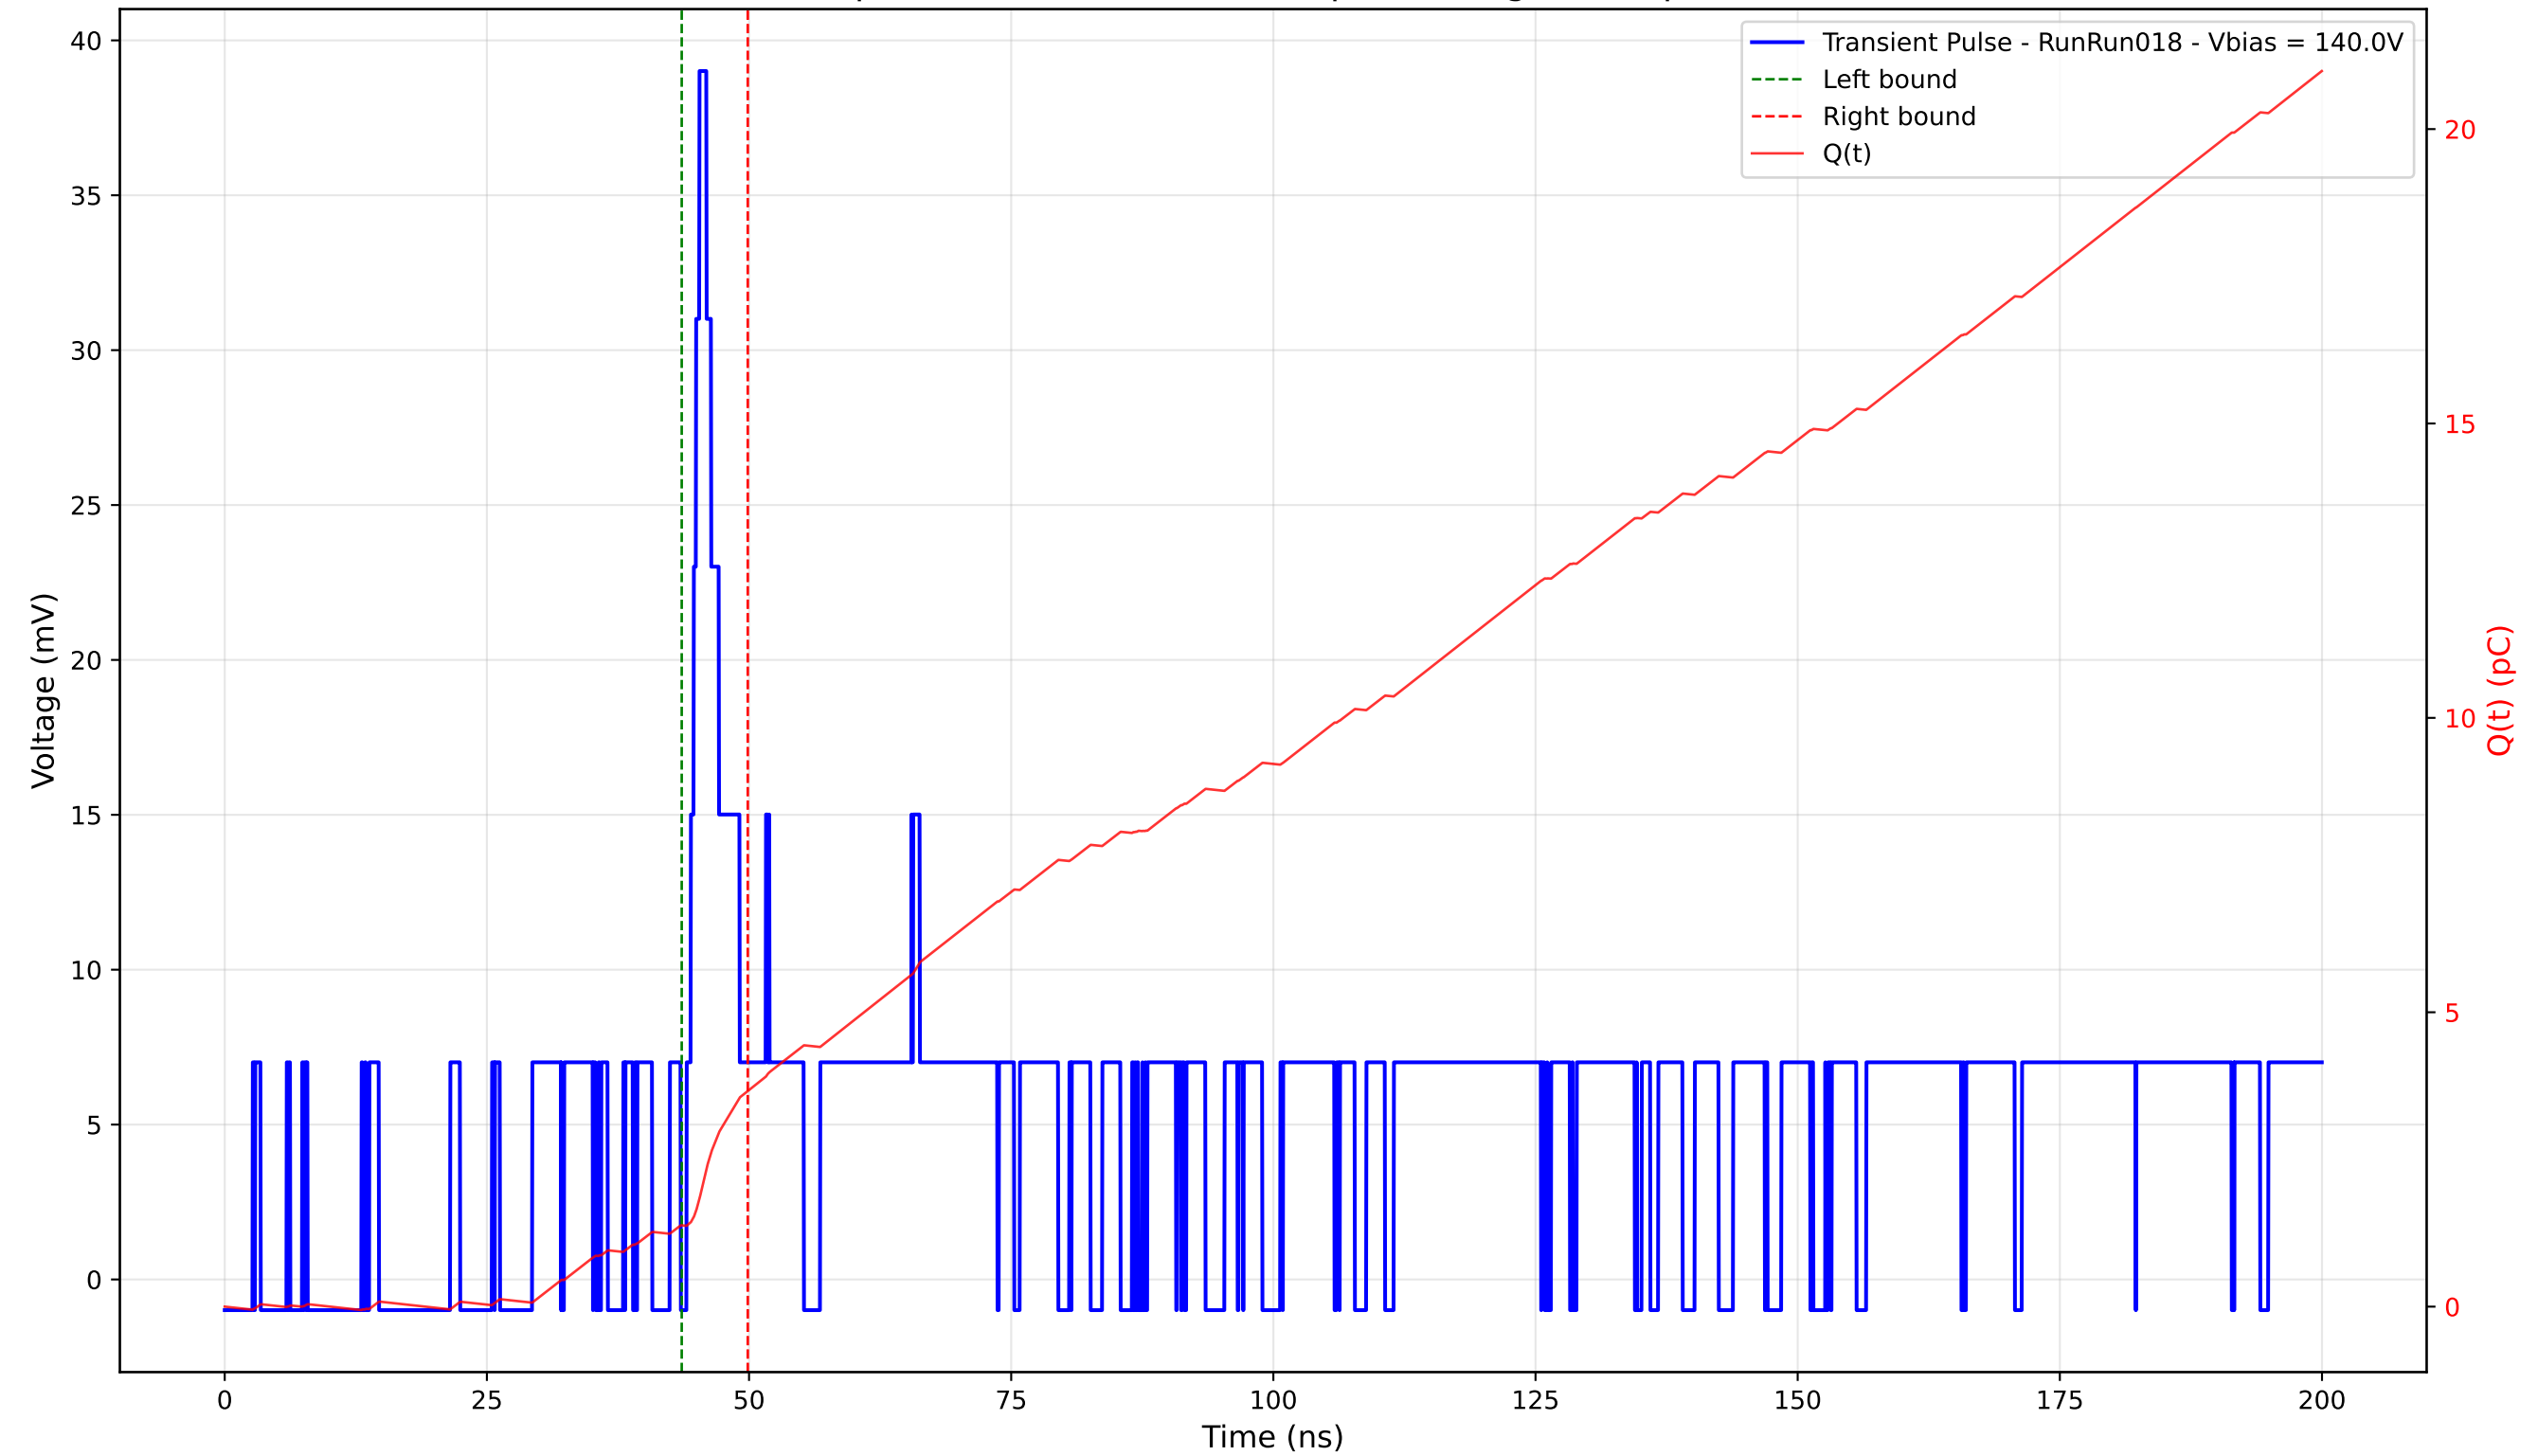


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 2.06 pC - Rise Time: 0.00 ns (N/A)

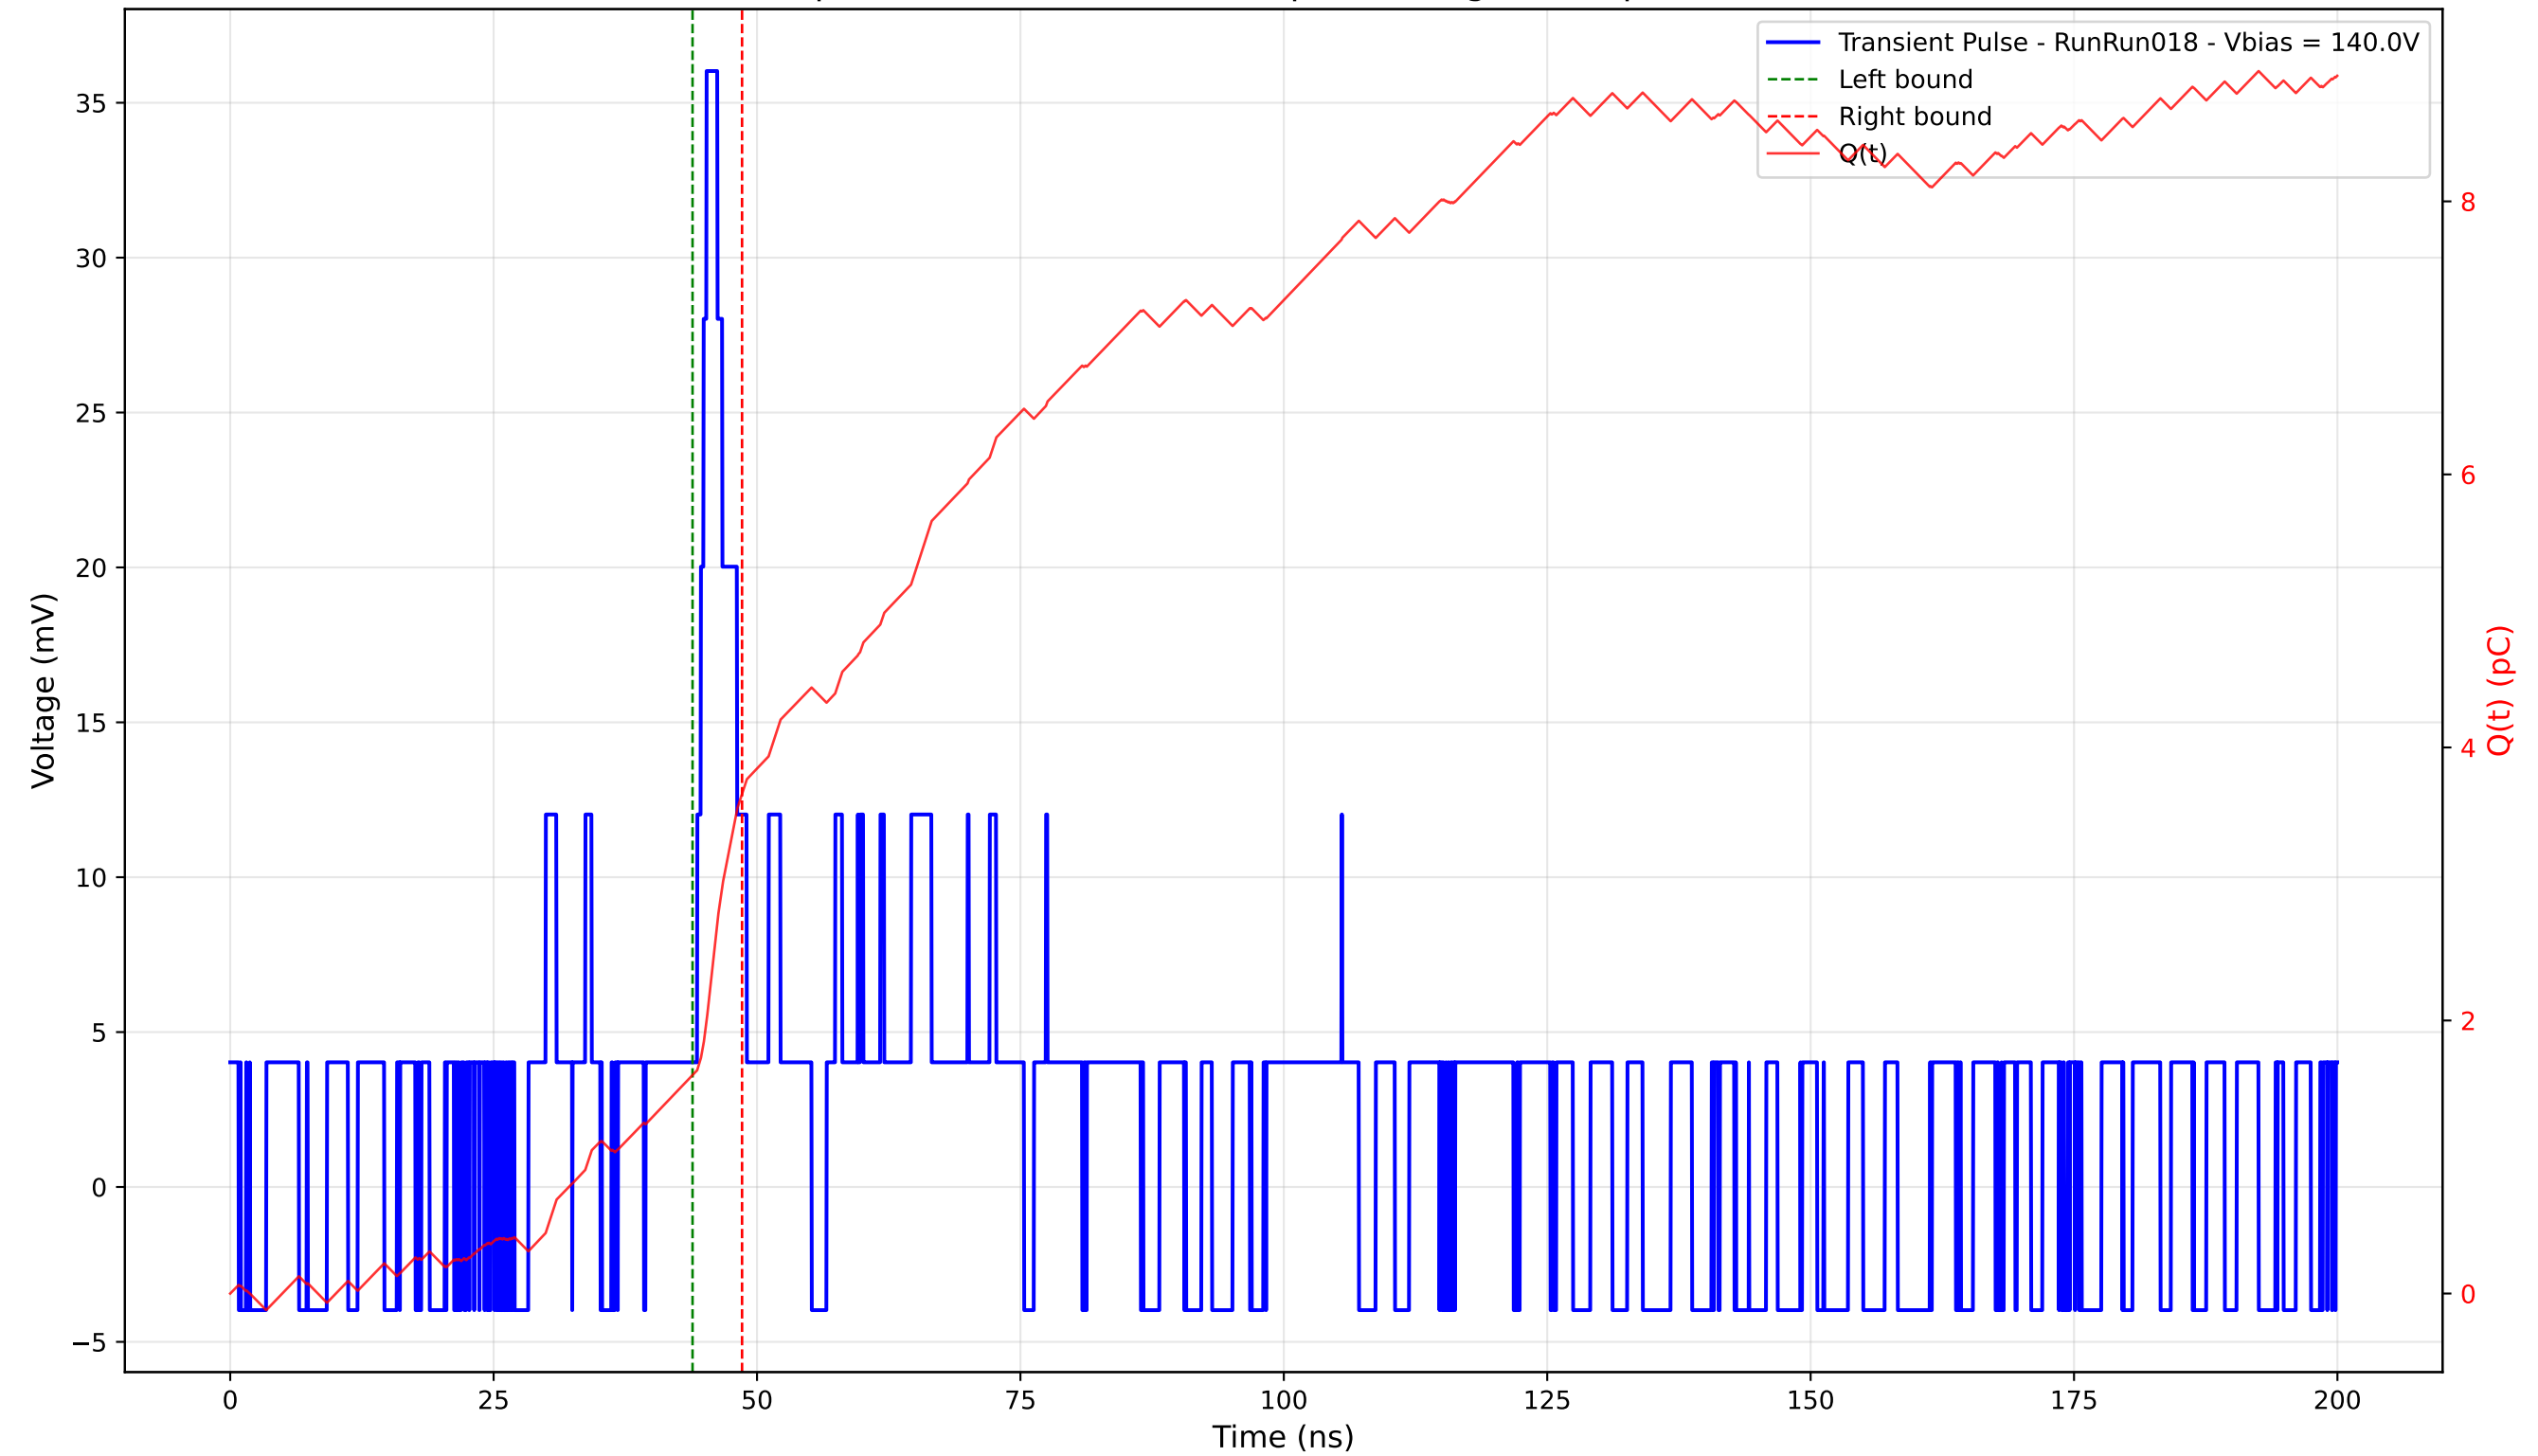


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 2.63 pC - Rise Time: 1.27 ns

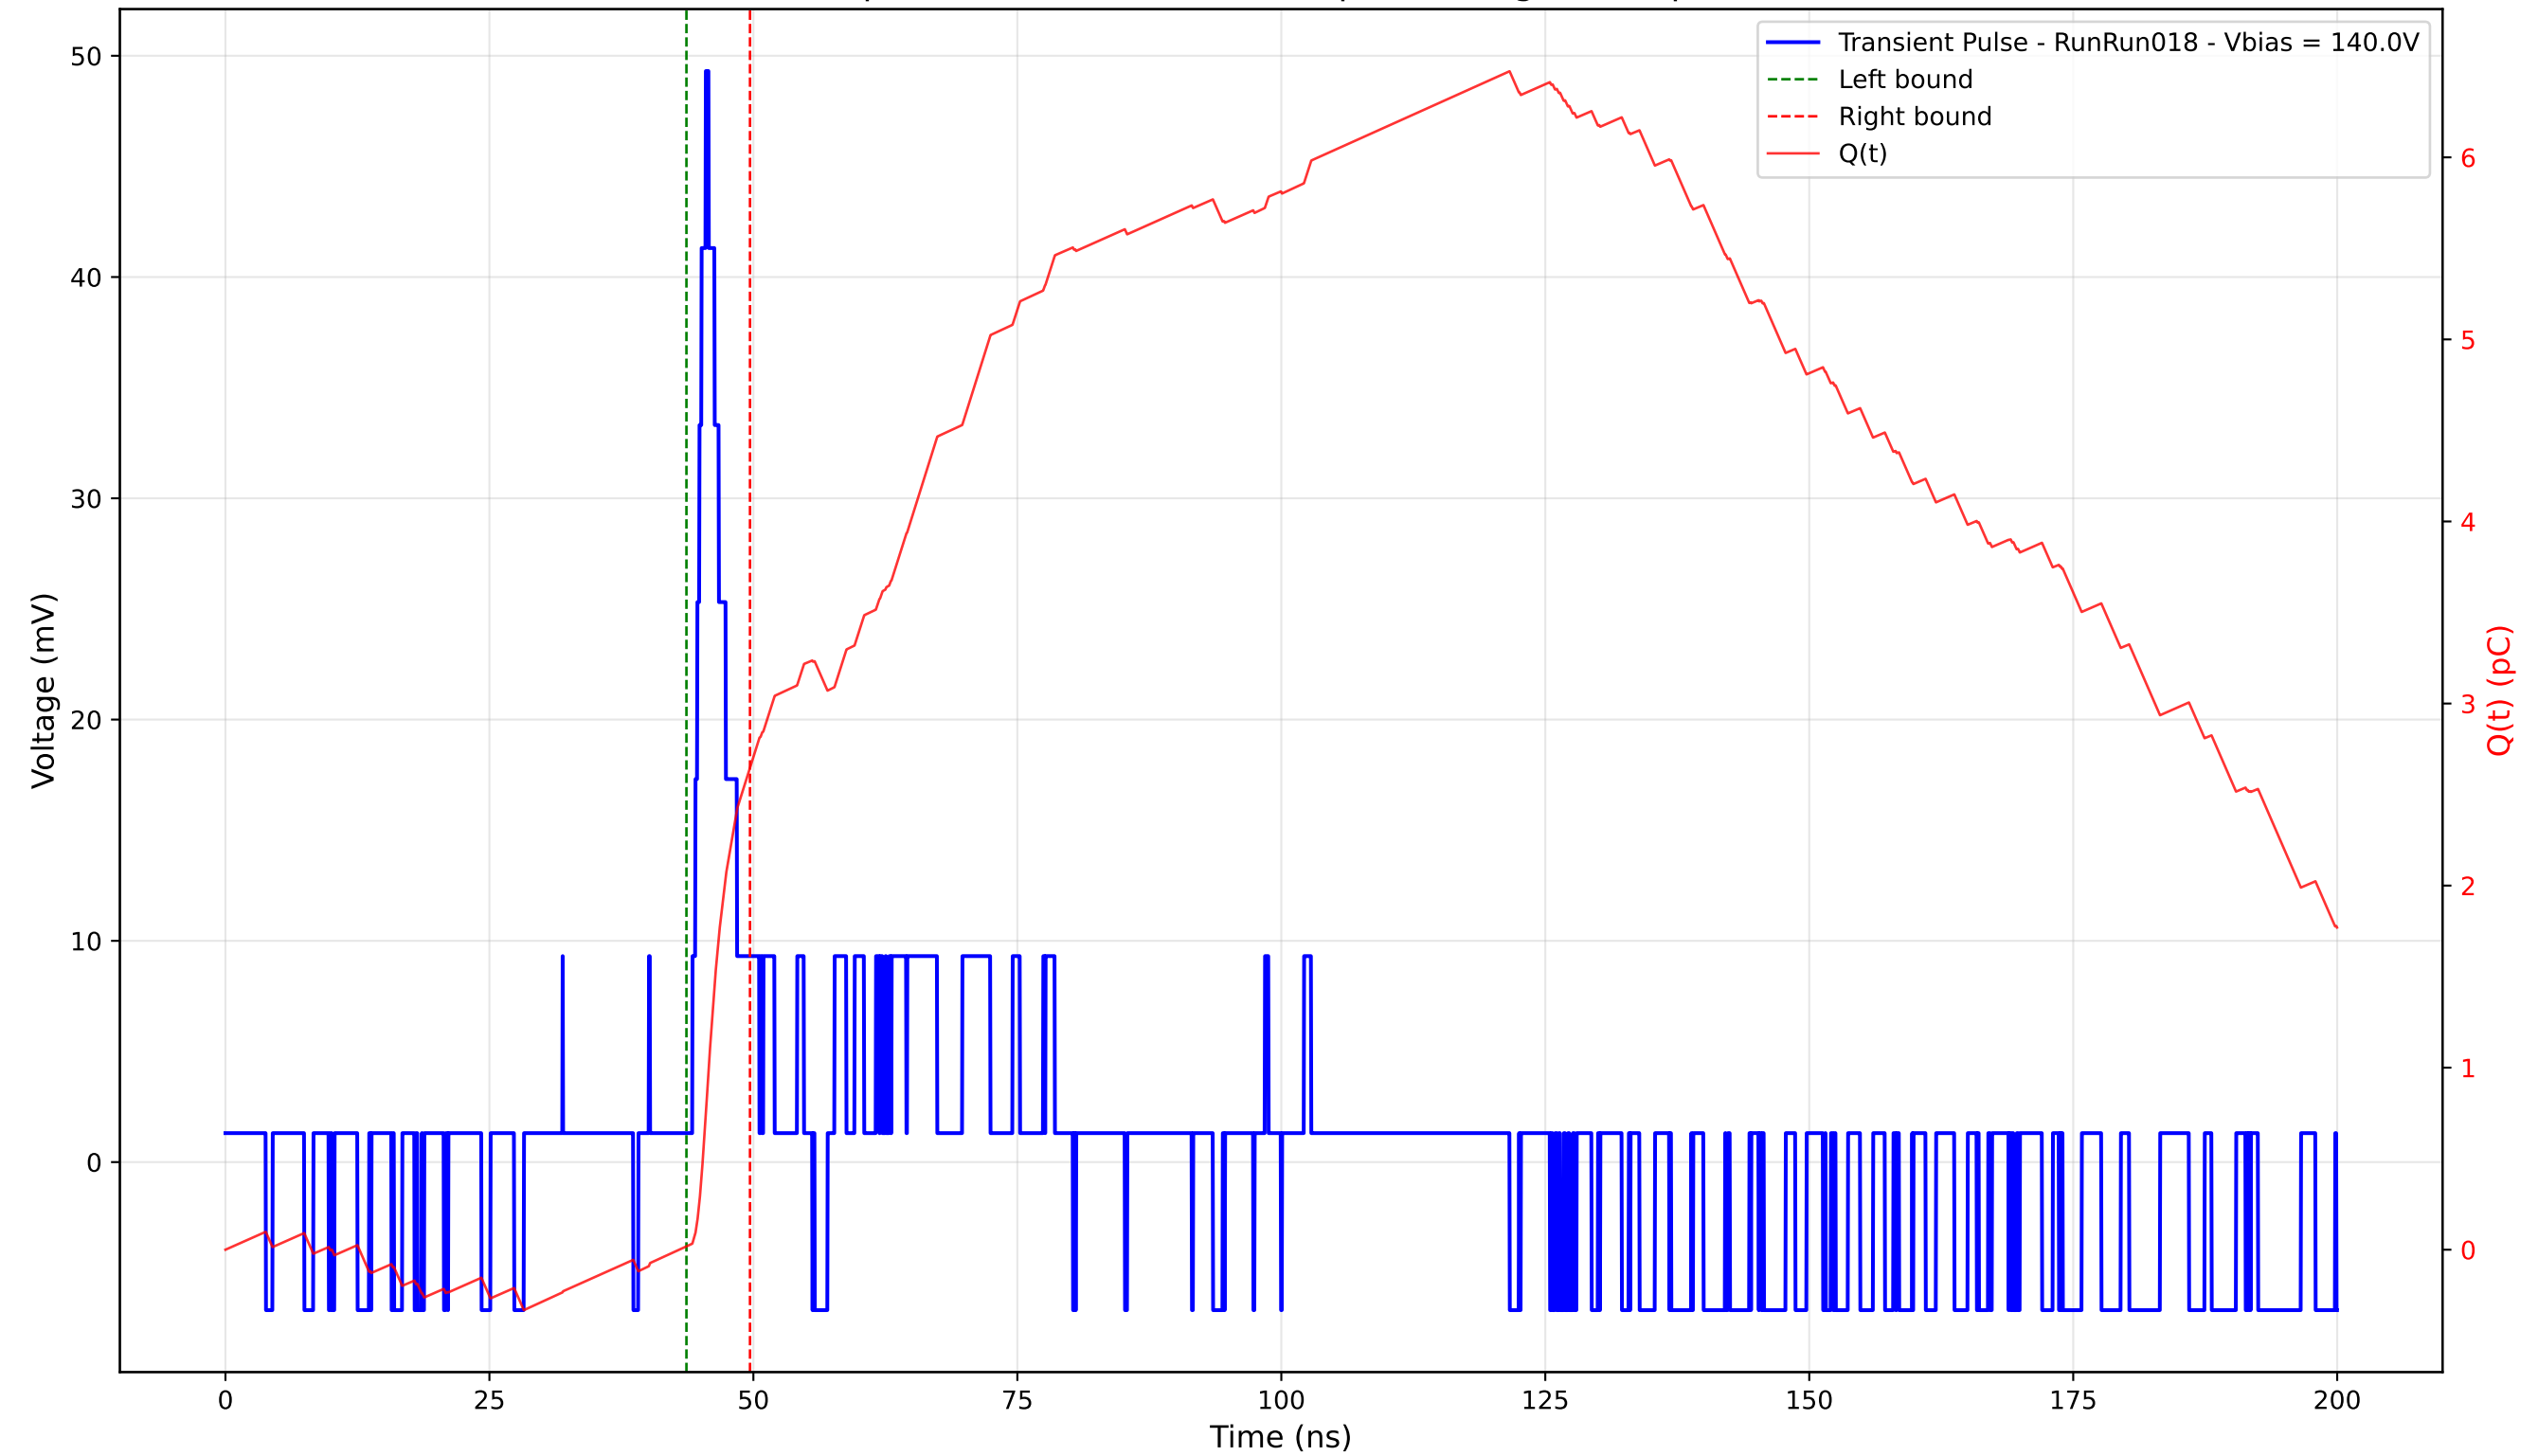


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 2.80 pC - Rise Time: 1.23 ns

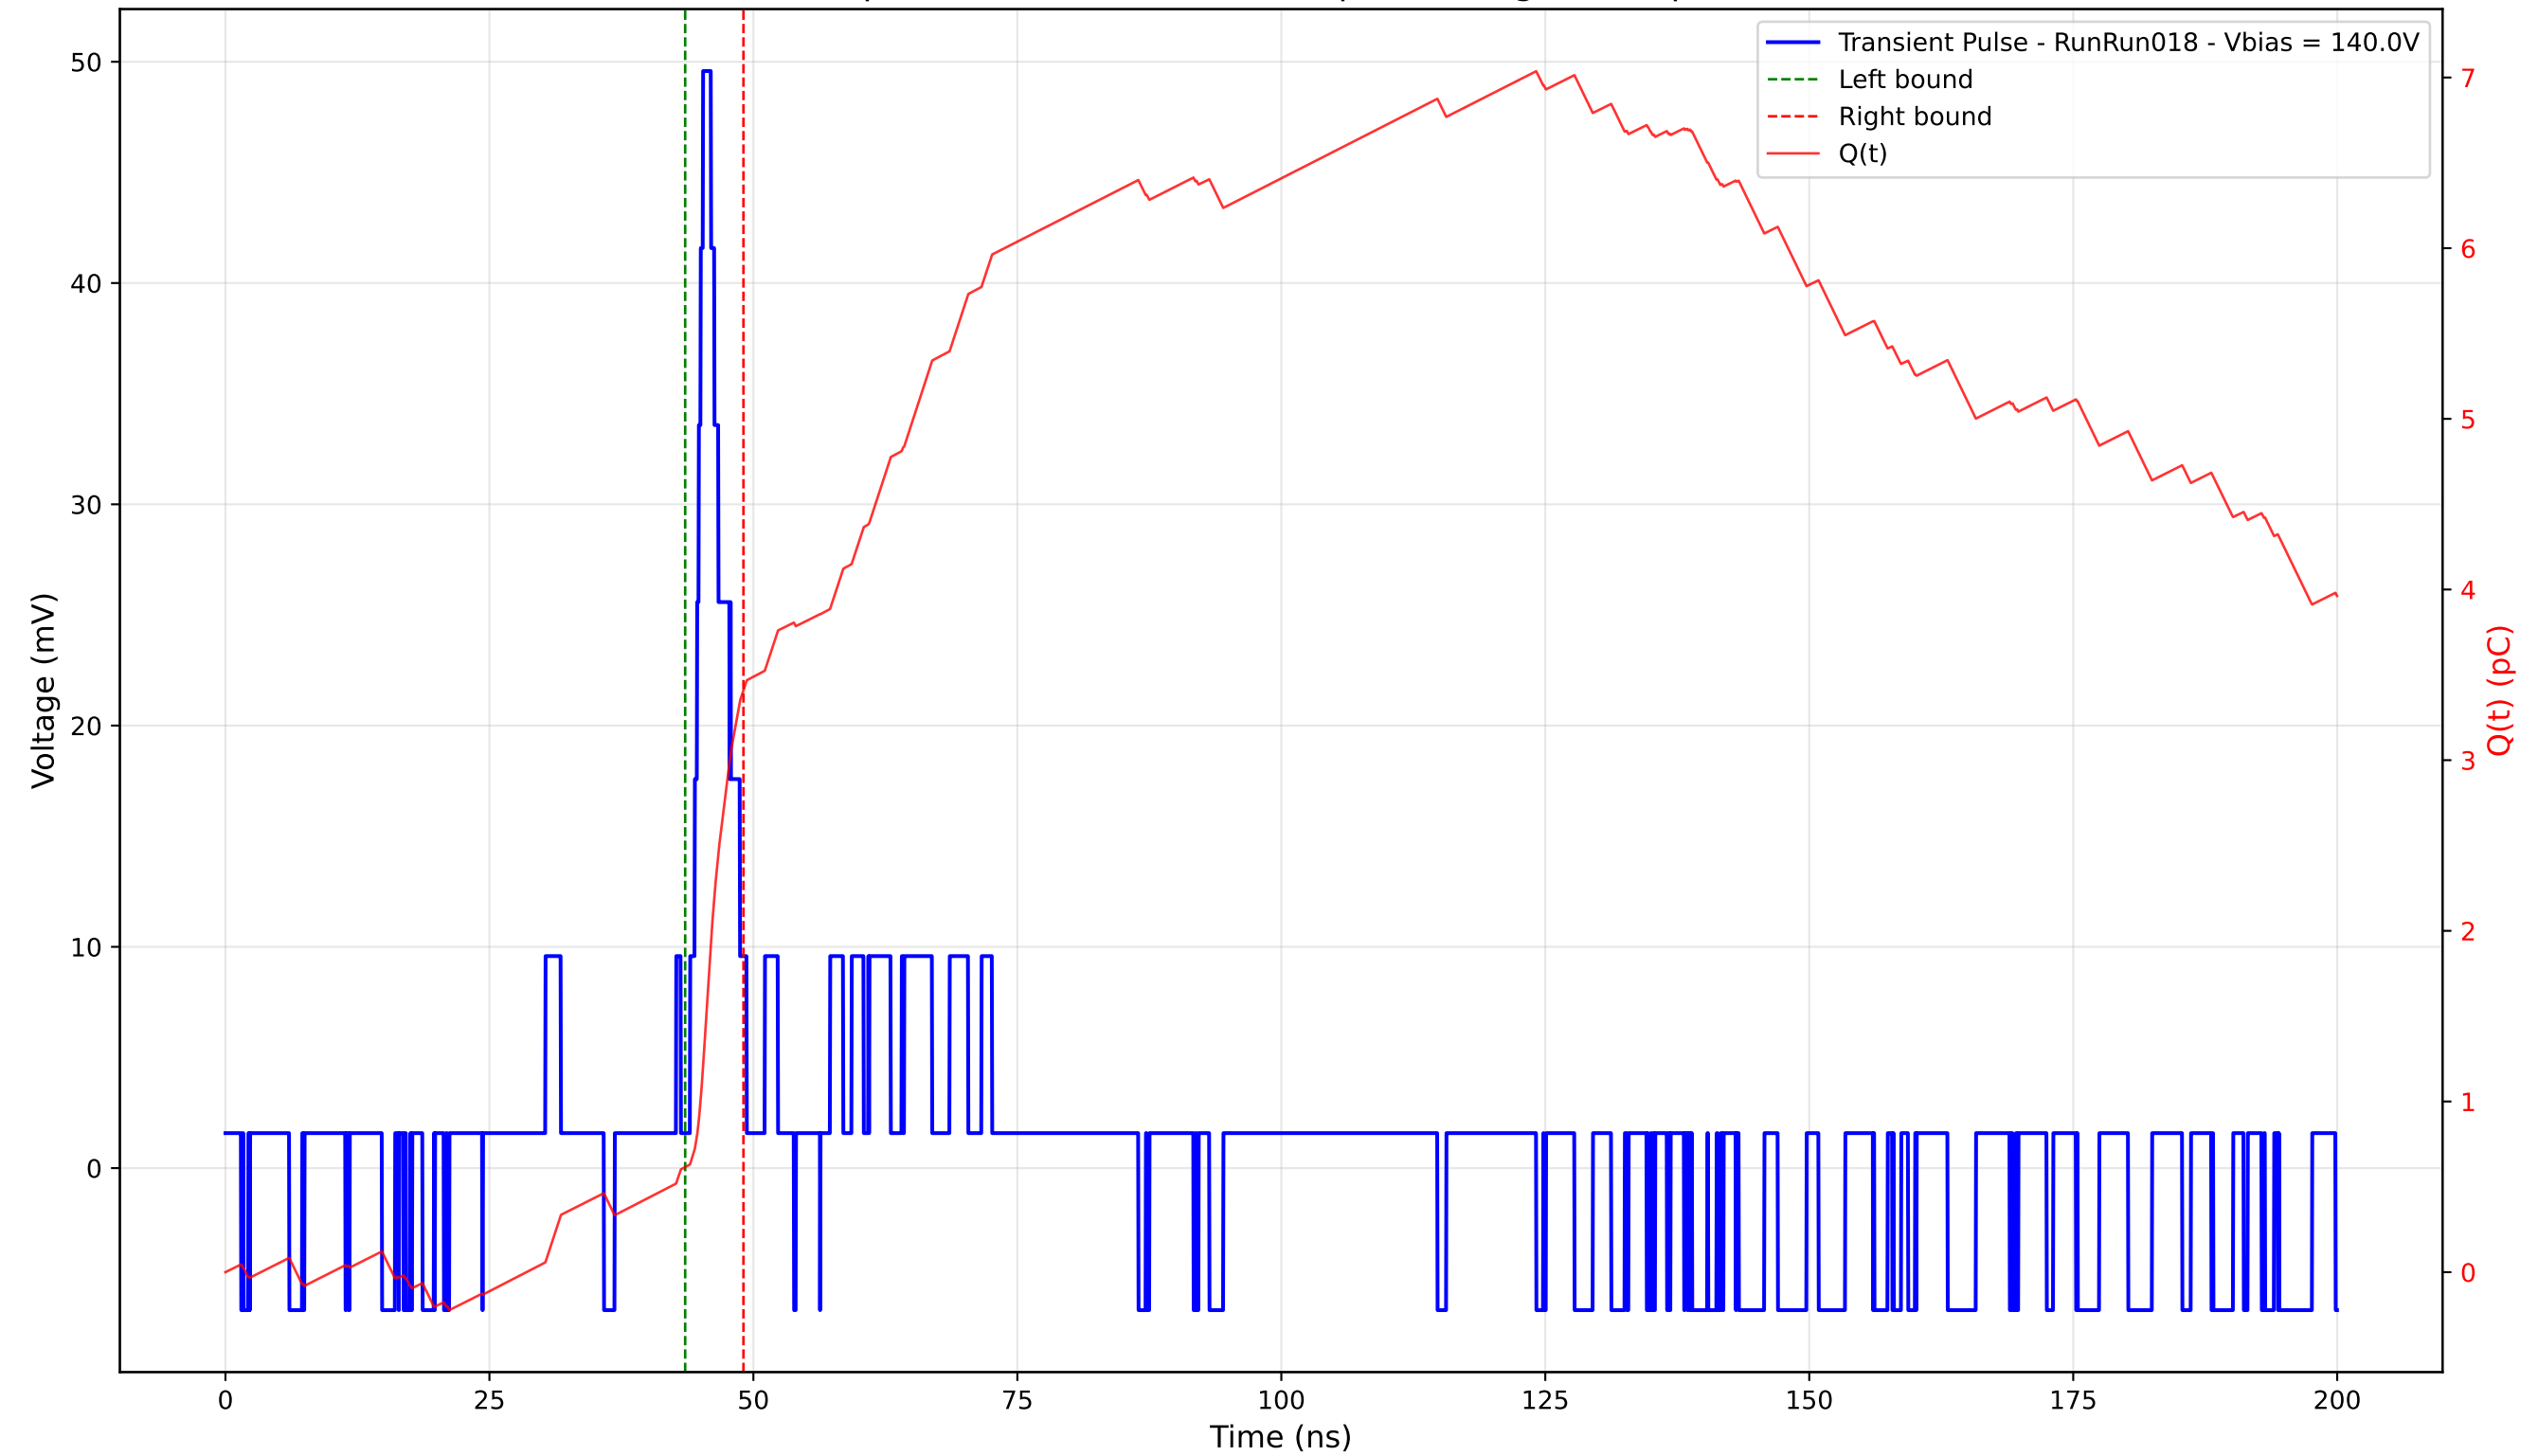


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 3.14 pC - Rise Time: 2.98 ns

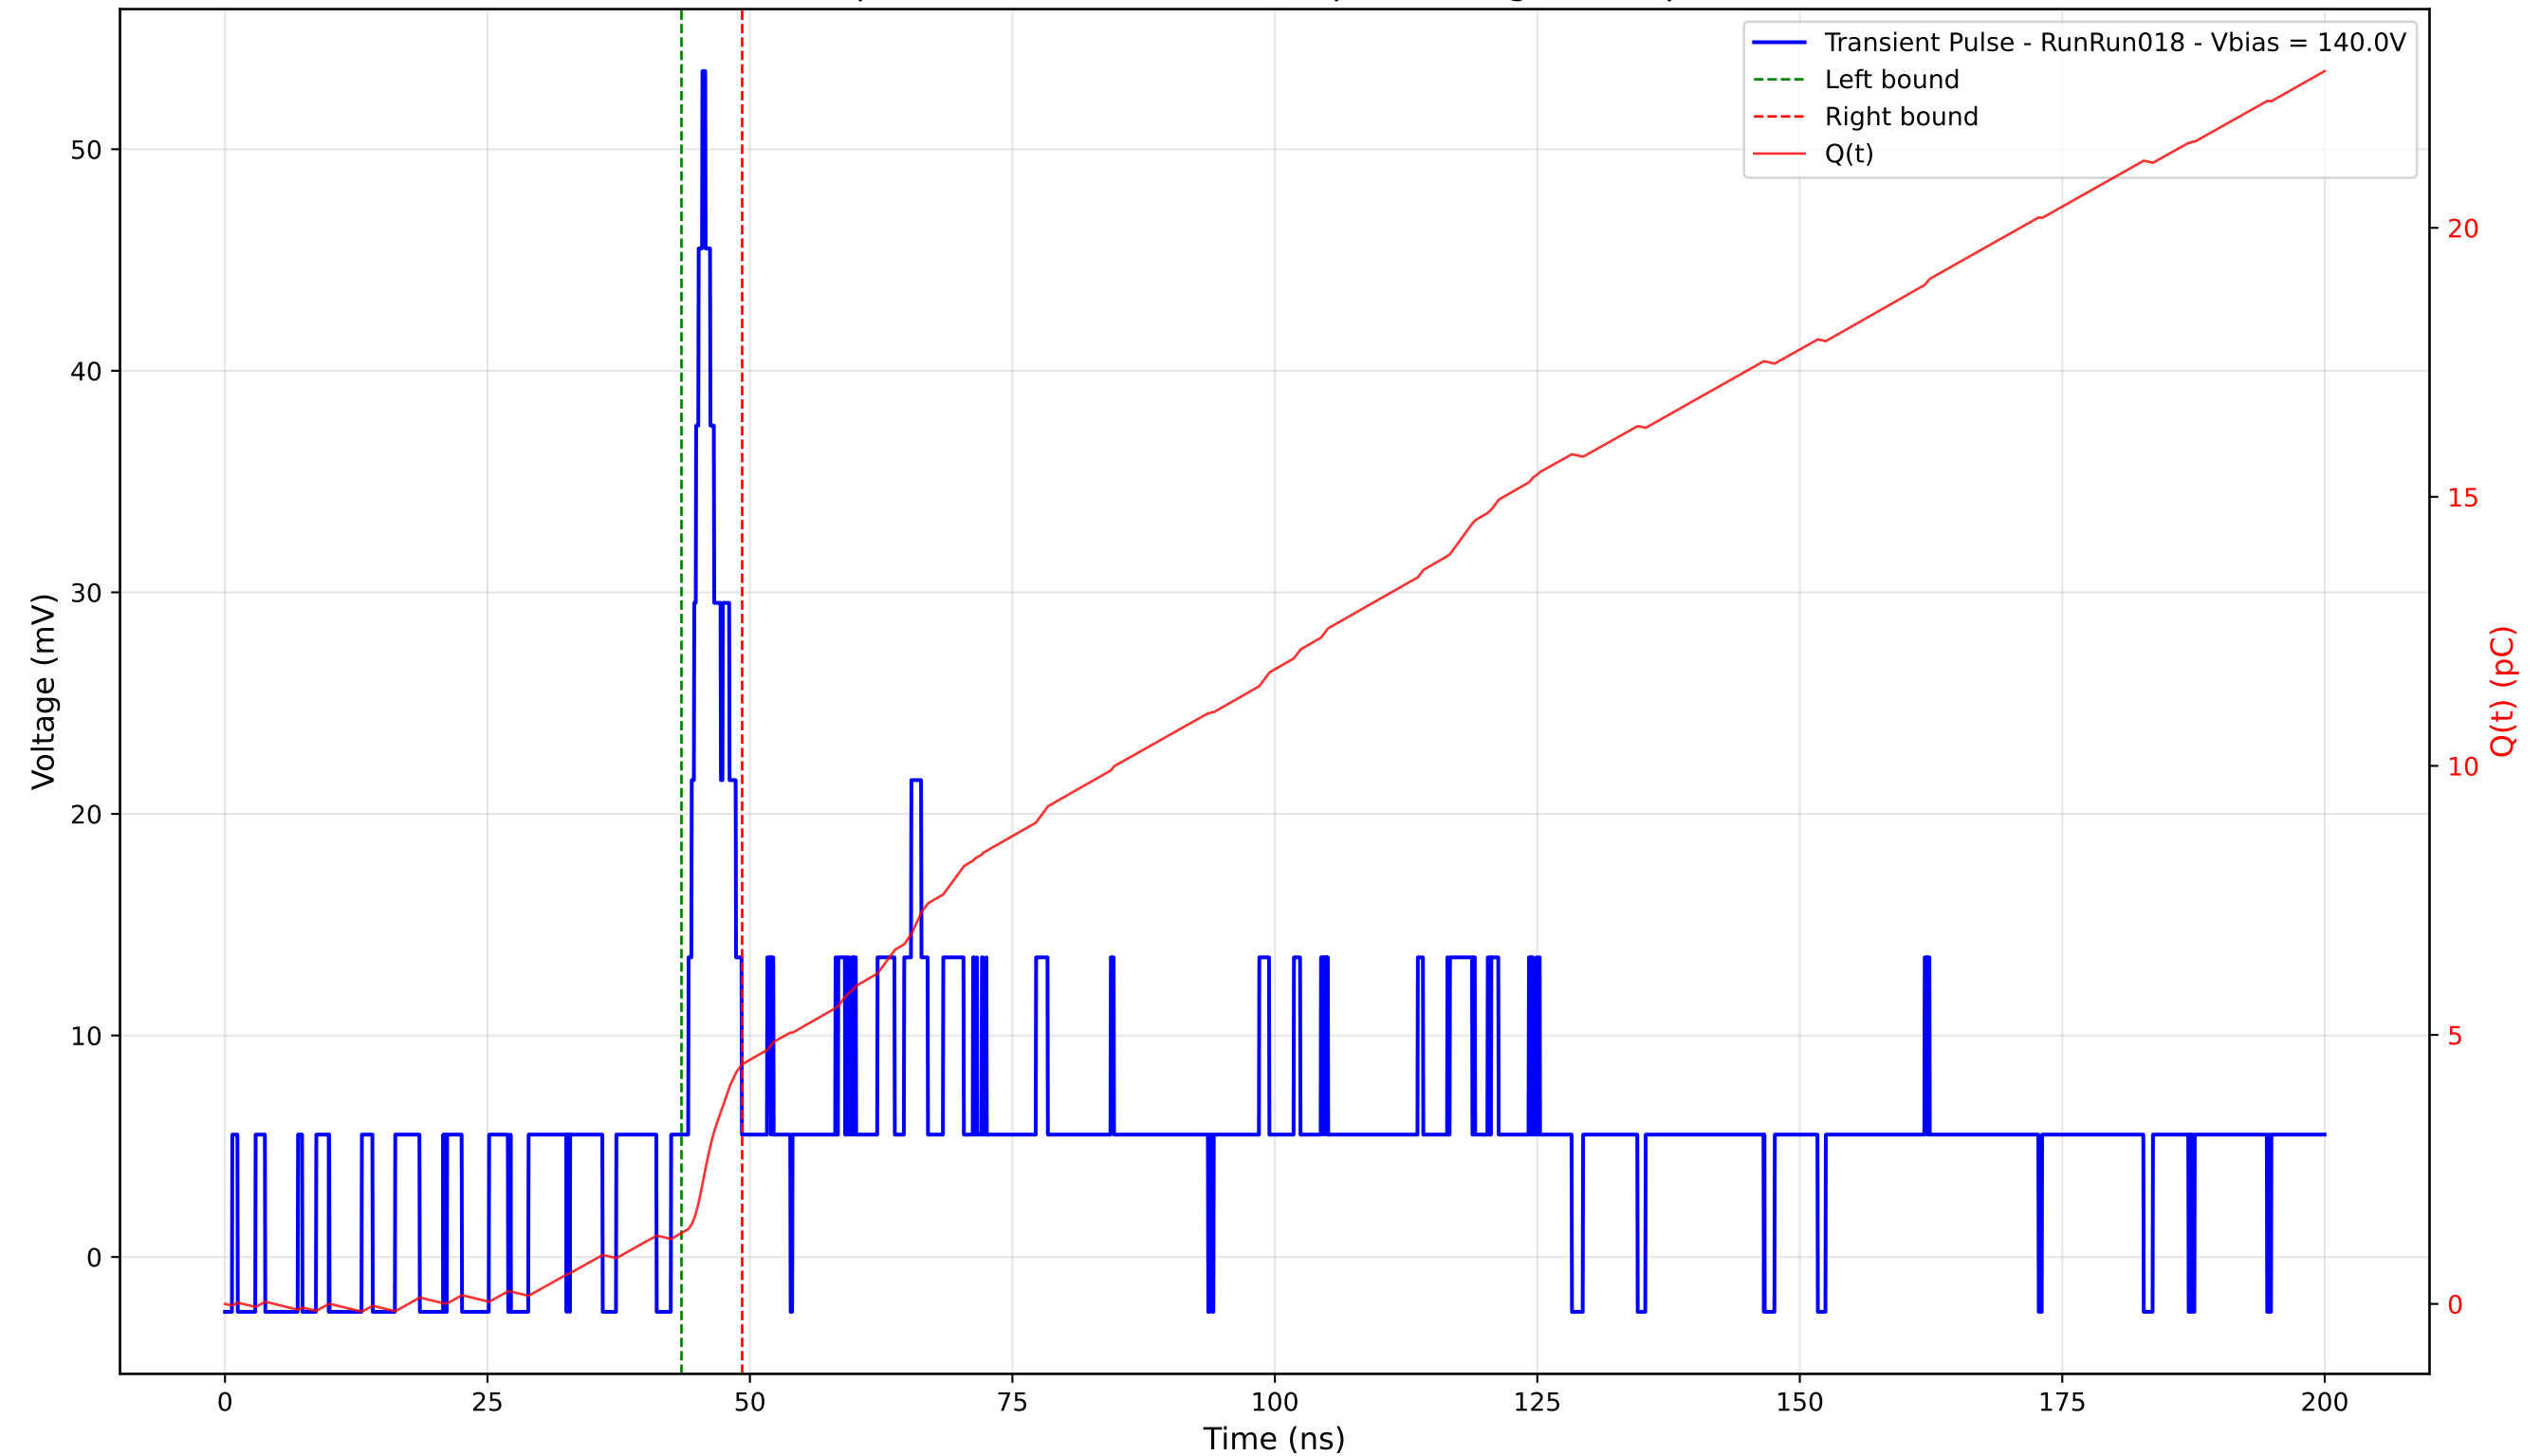


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 2.58 pC - Rise Time: 1.40 ns

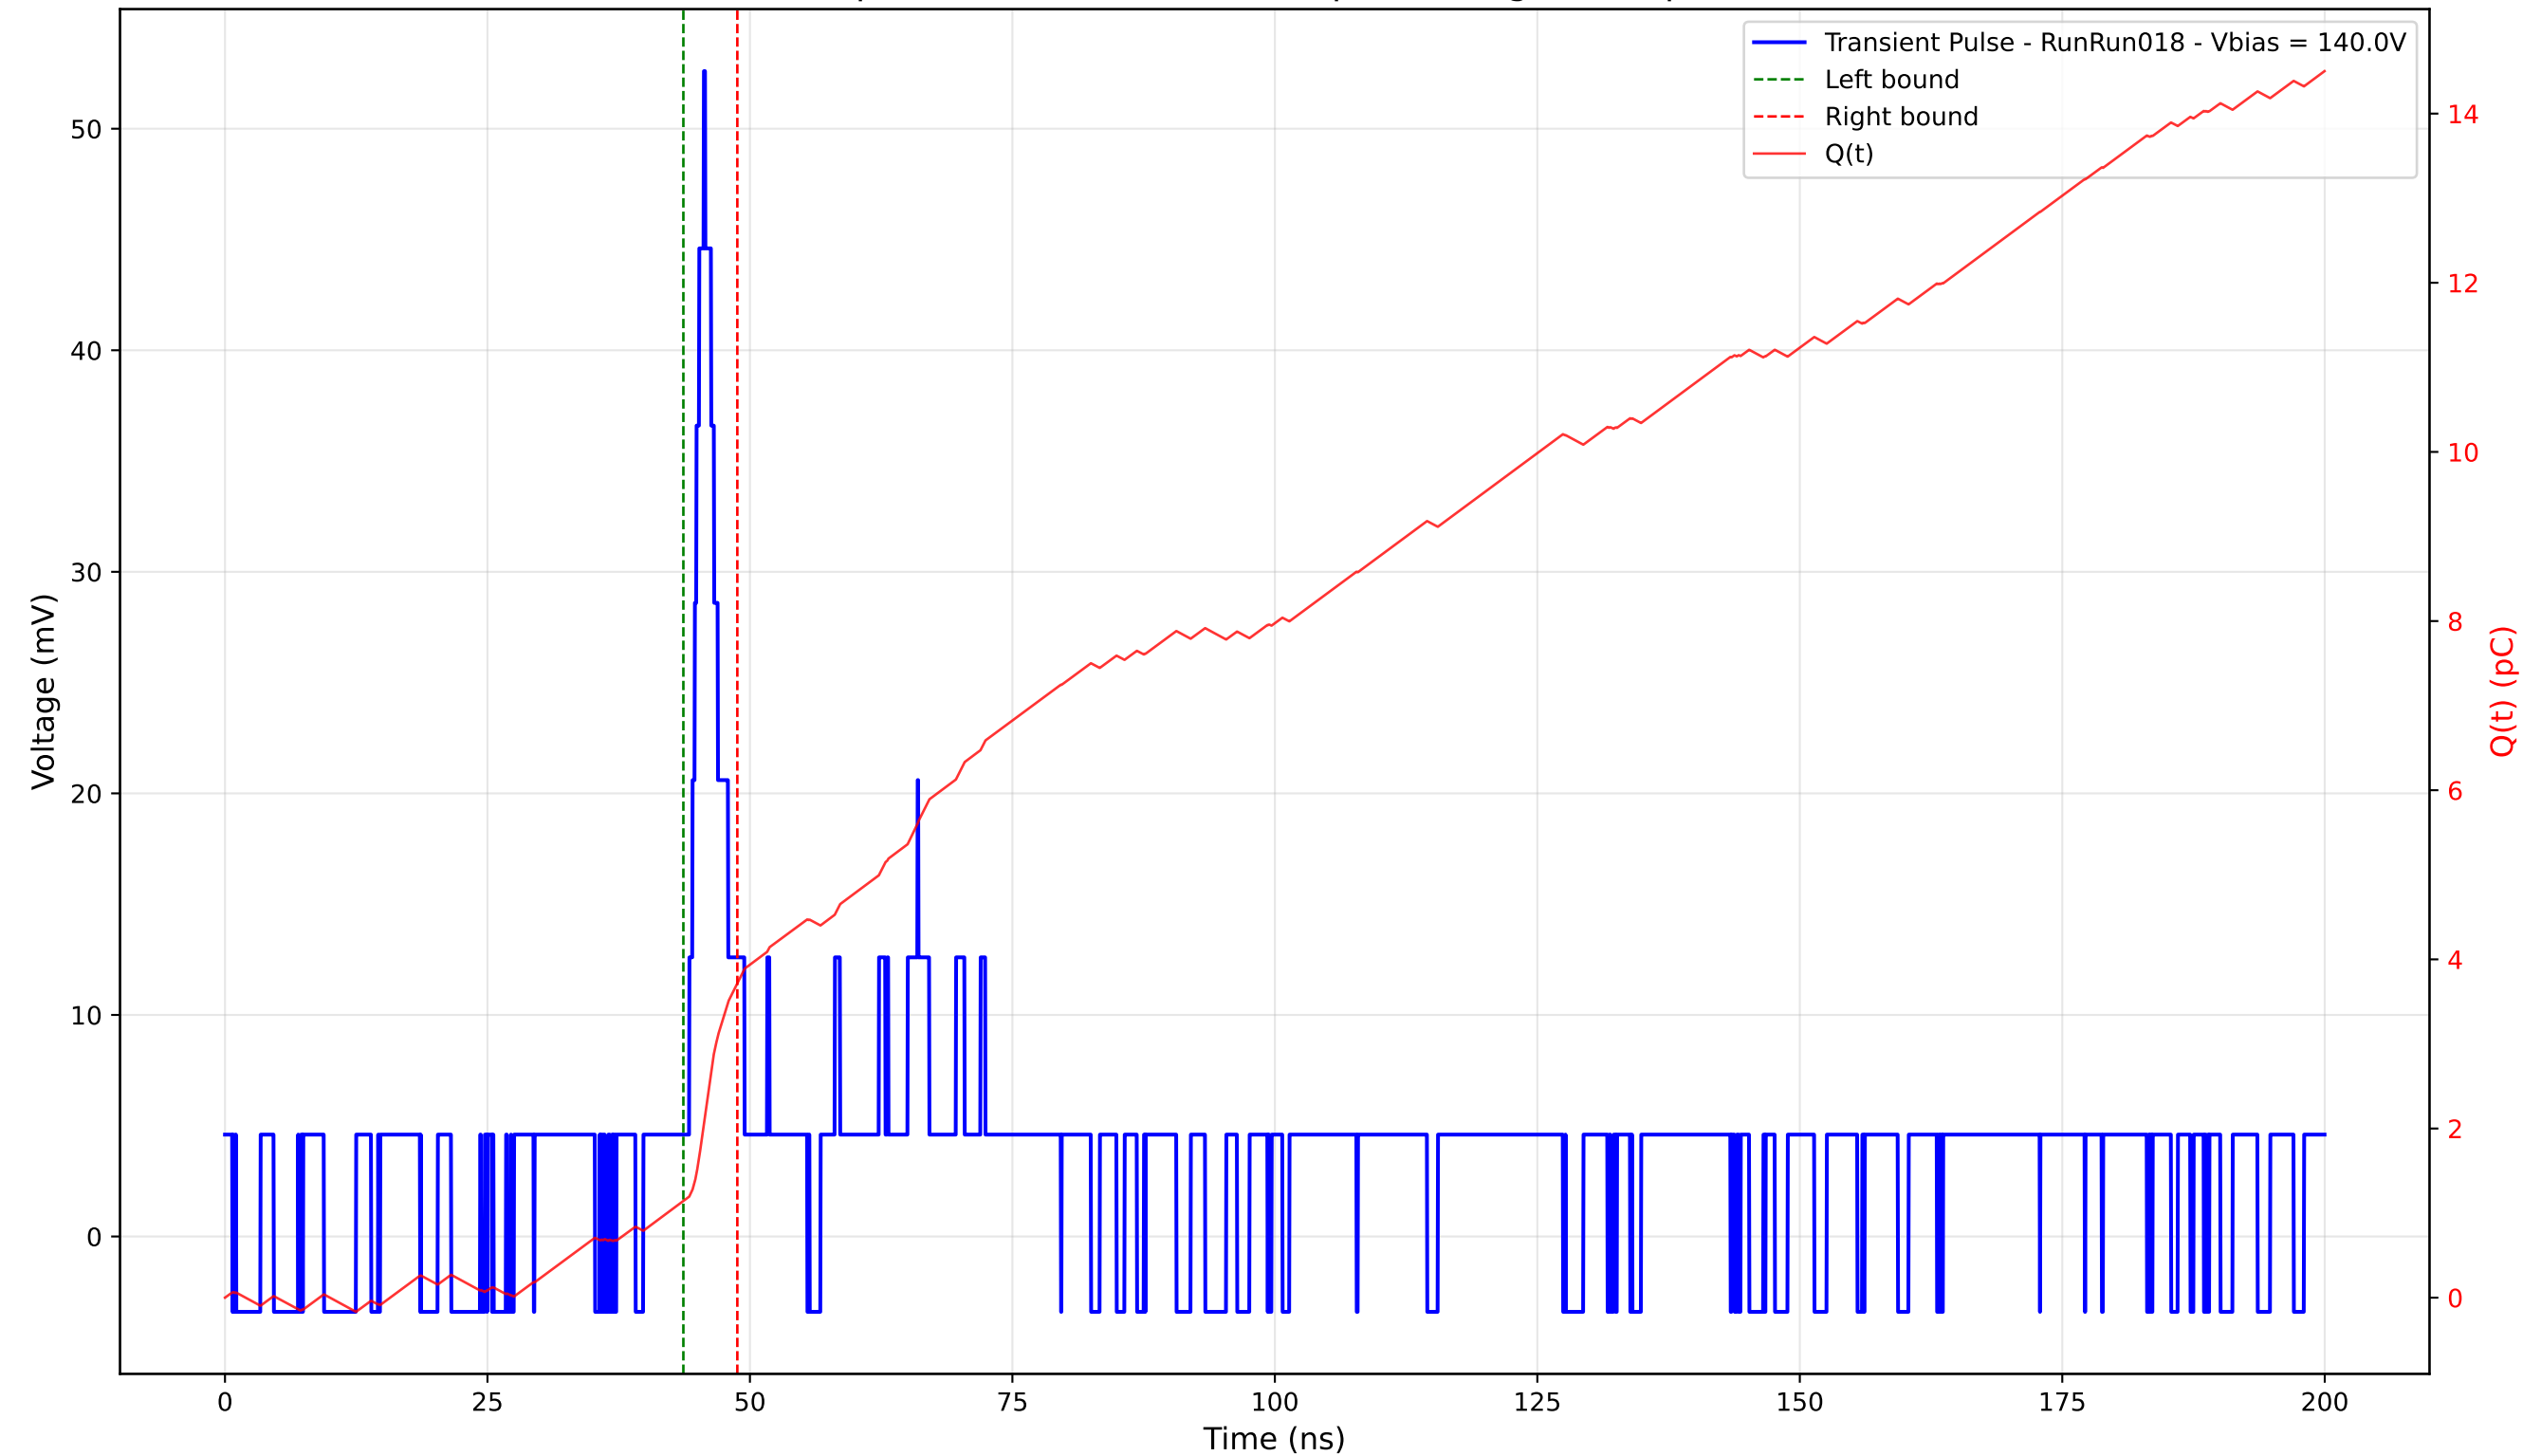


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 2.37 pC - Rise Time: 1.03 ns

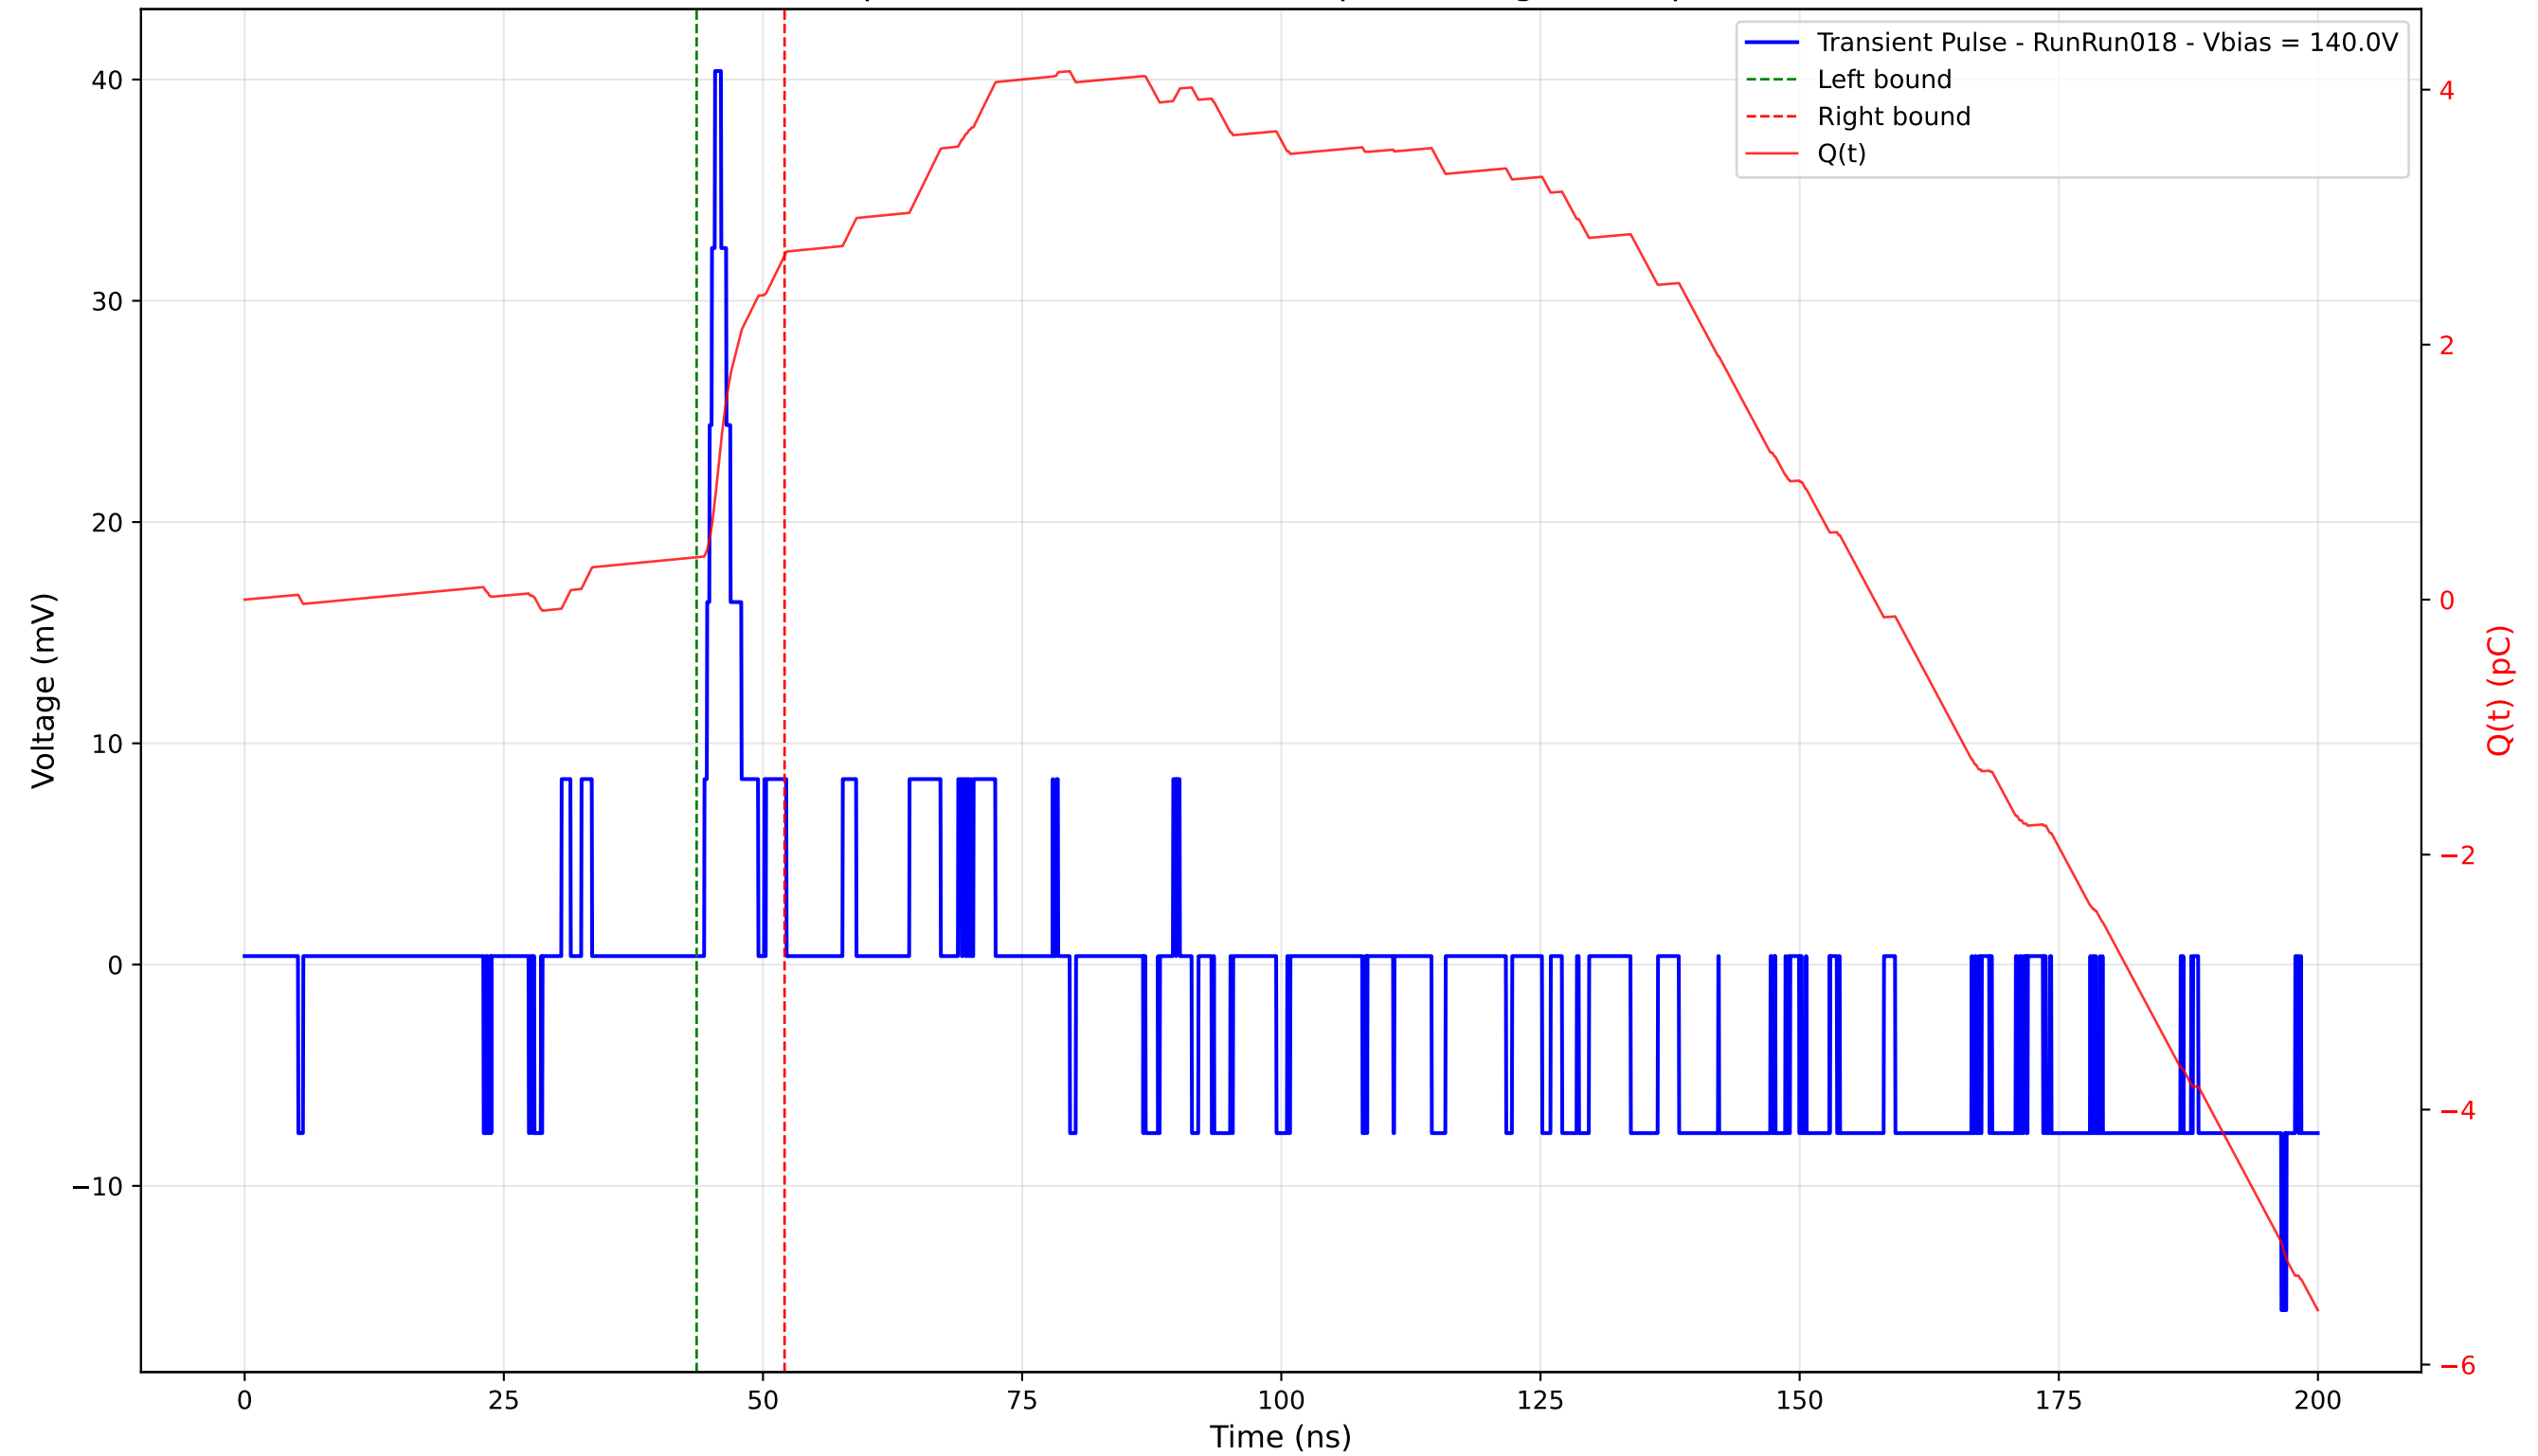


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 1.81 pC - Rise Time: 2.85 ns

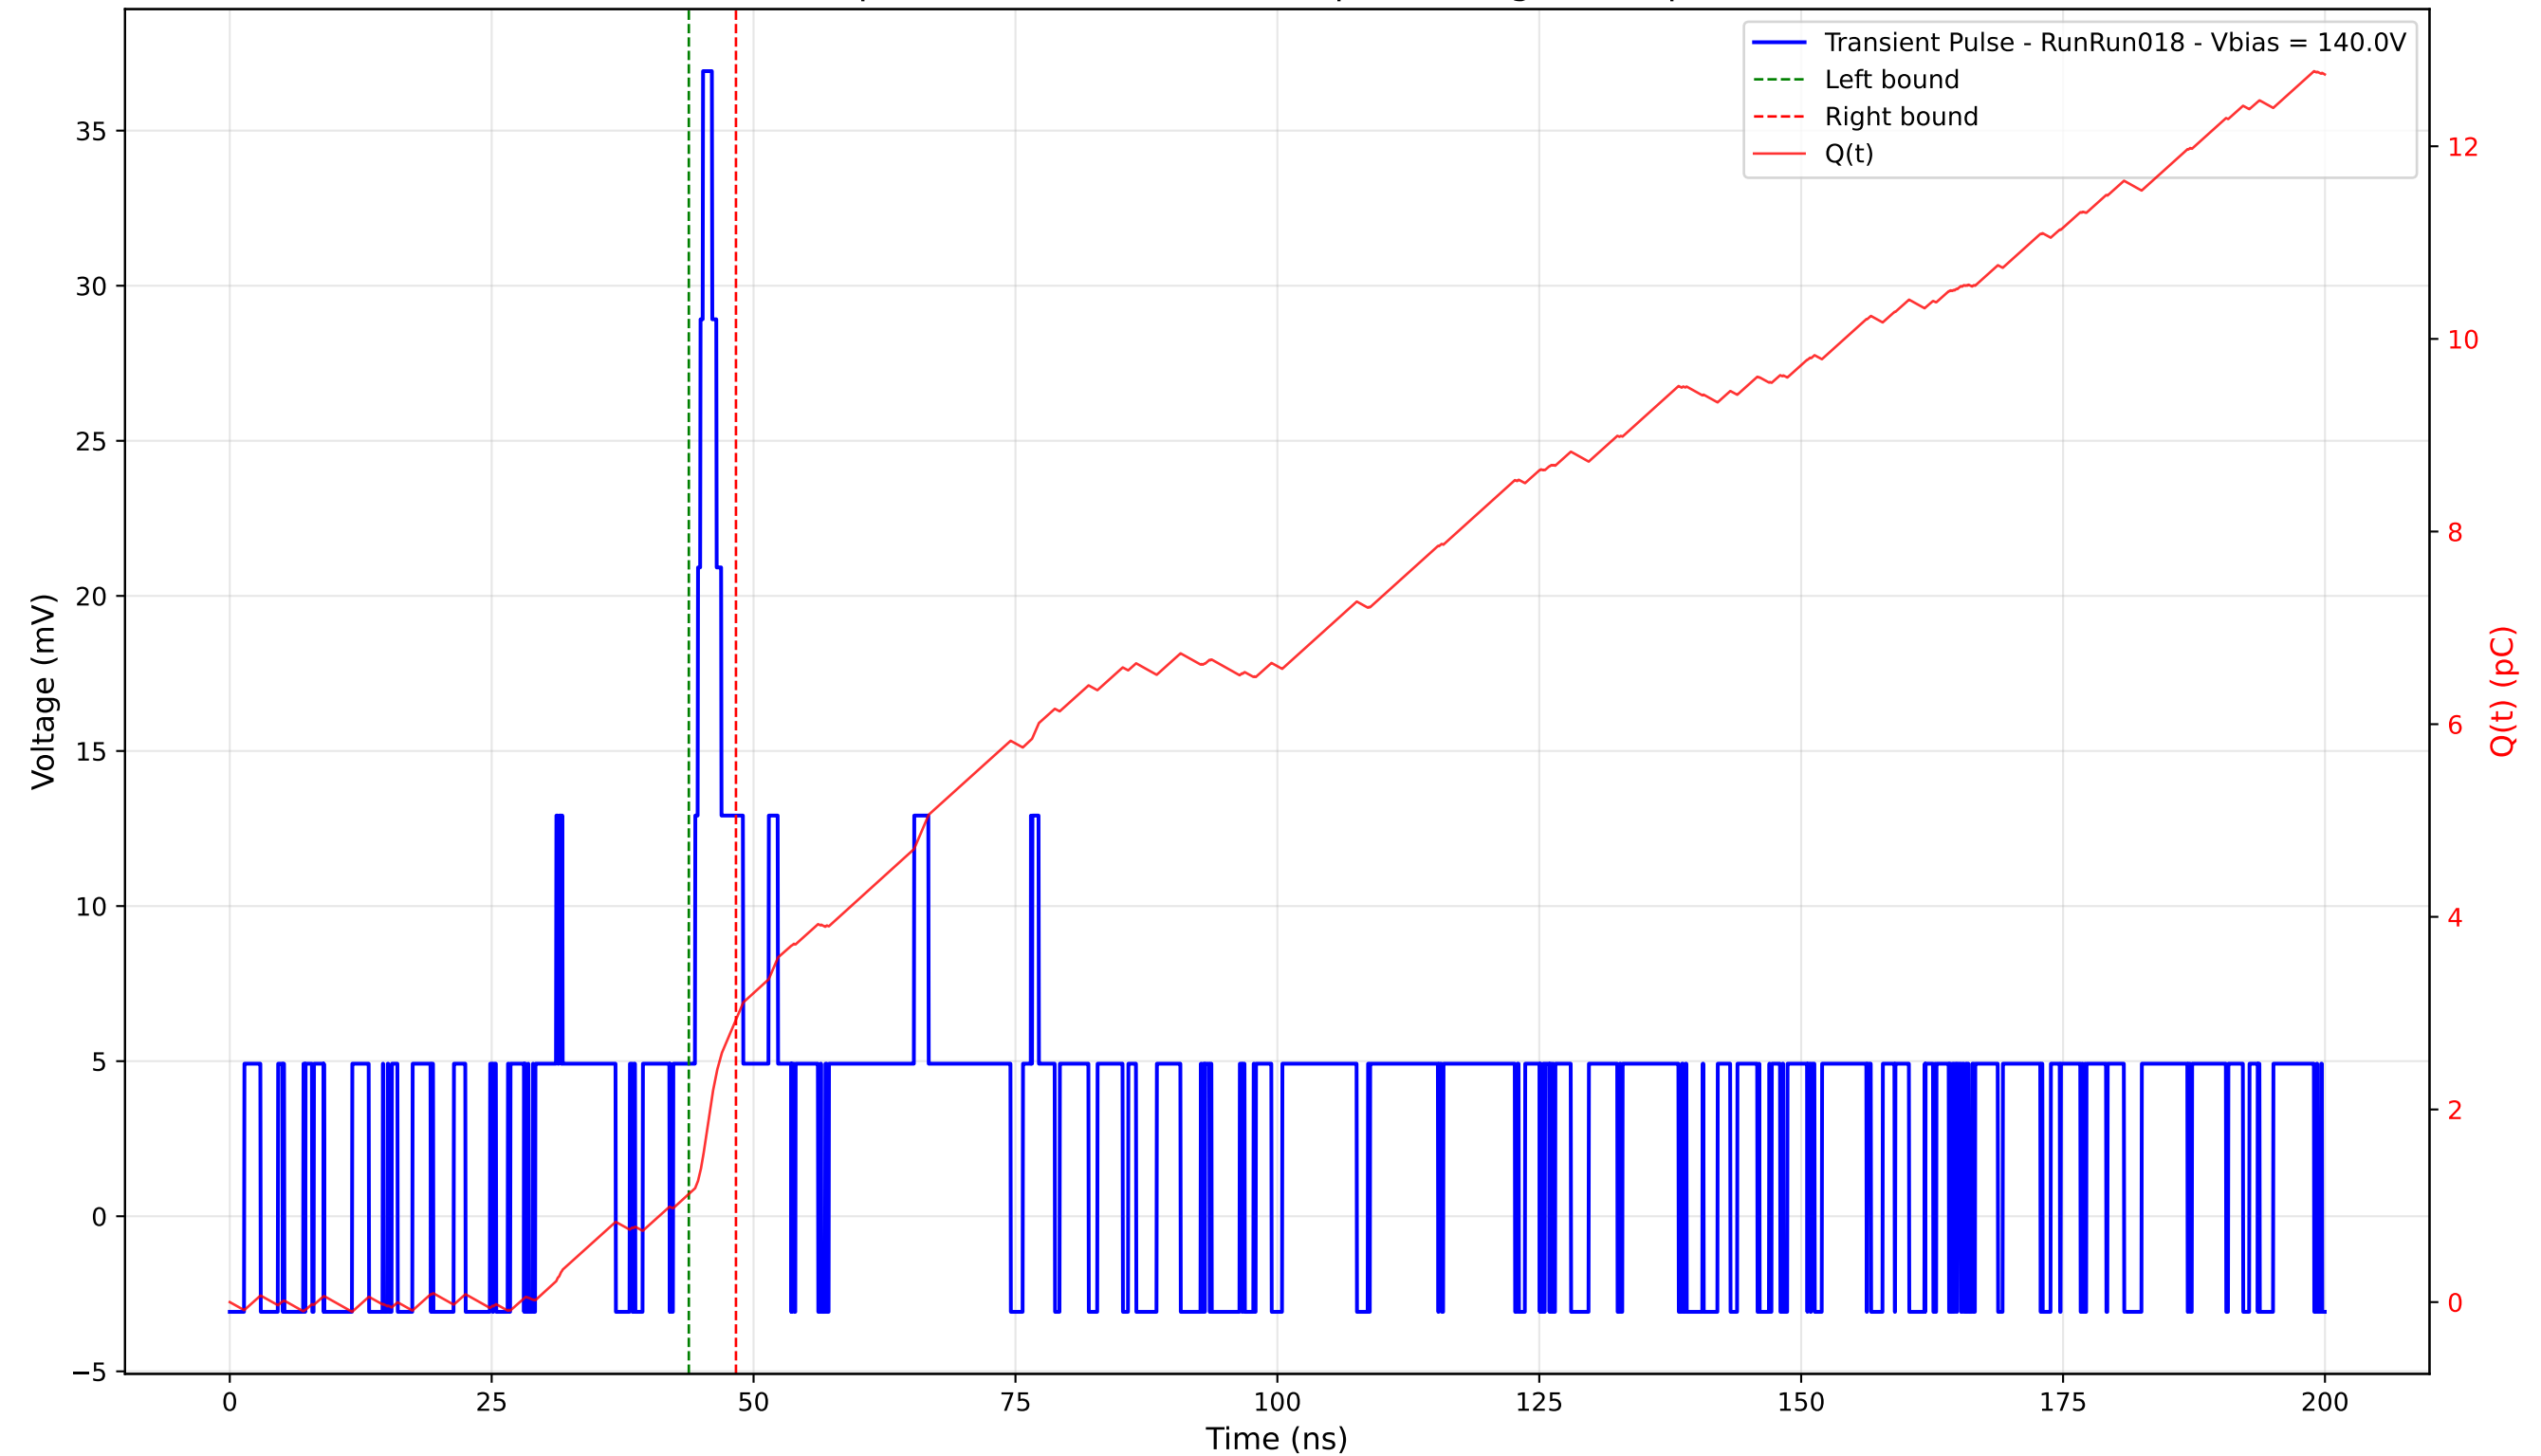

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.17 pC - Rise Time: 0.00 ns (N/A)

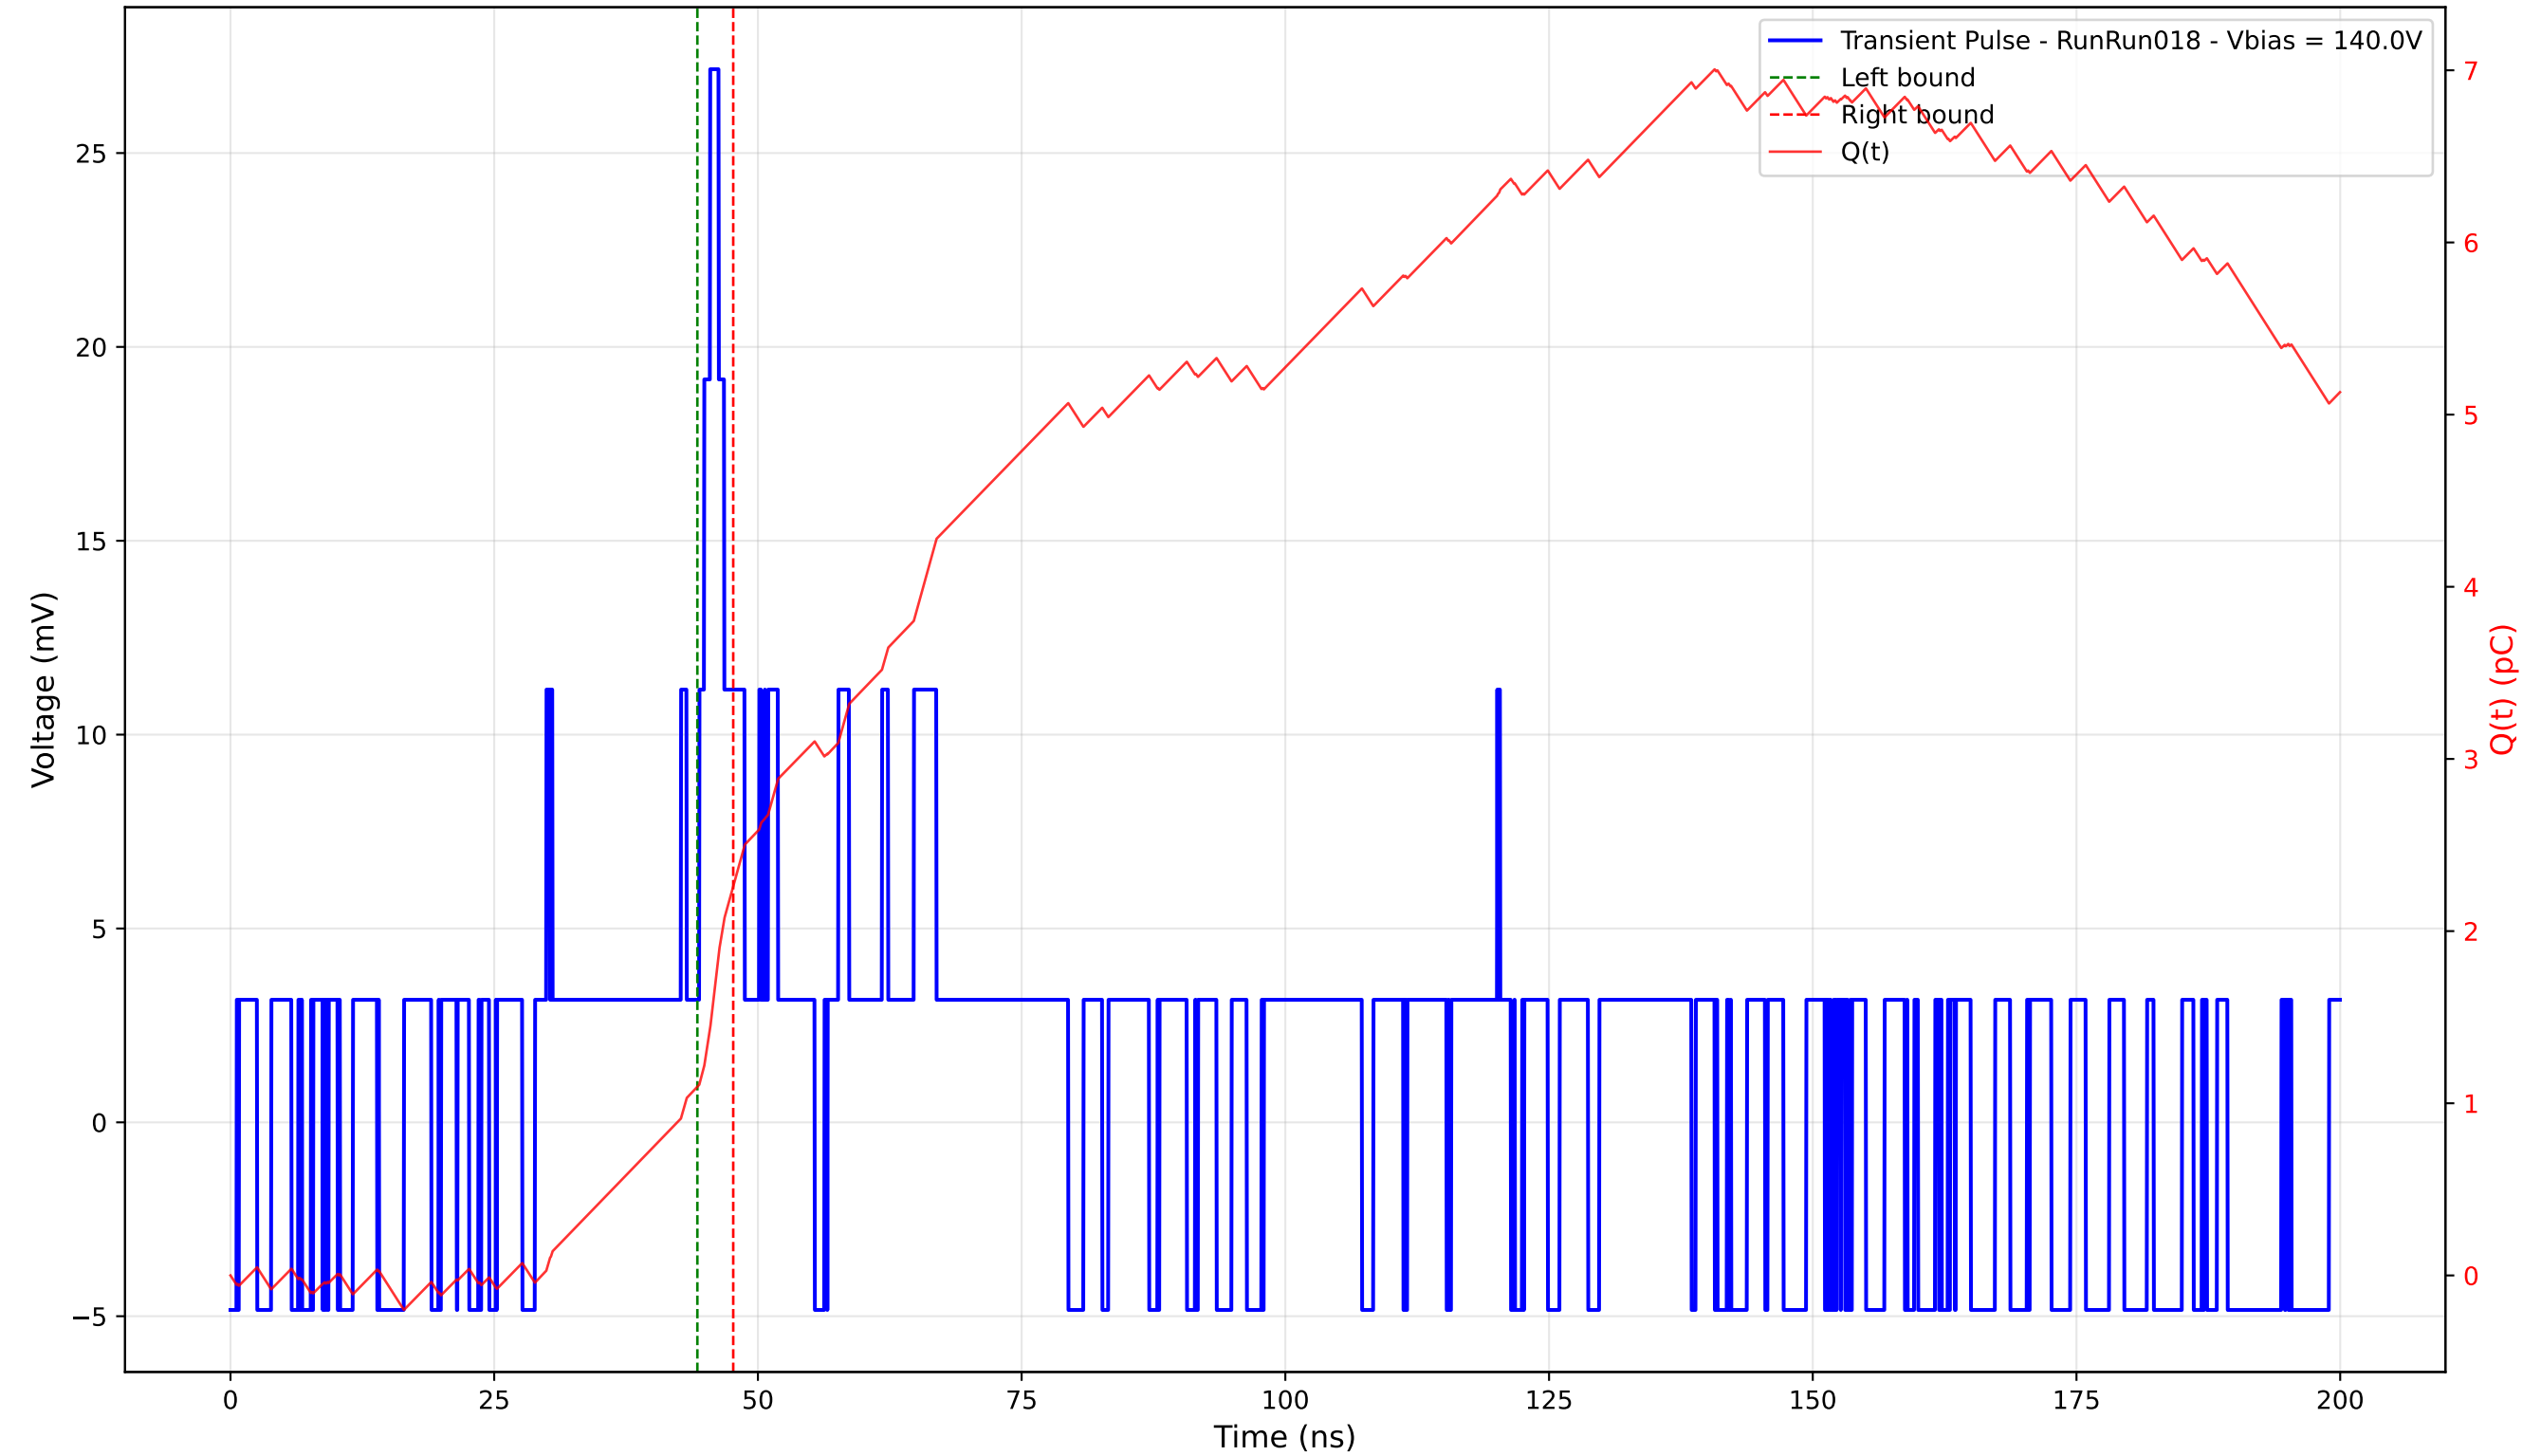

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 3.34 pC - Rise Time: 0.00 ns (N/A)

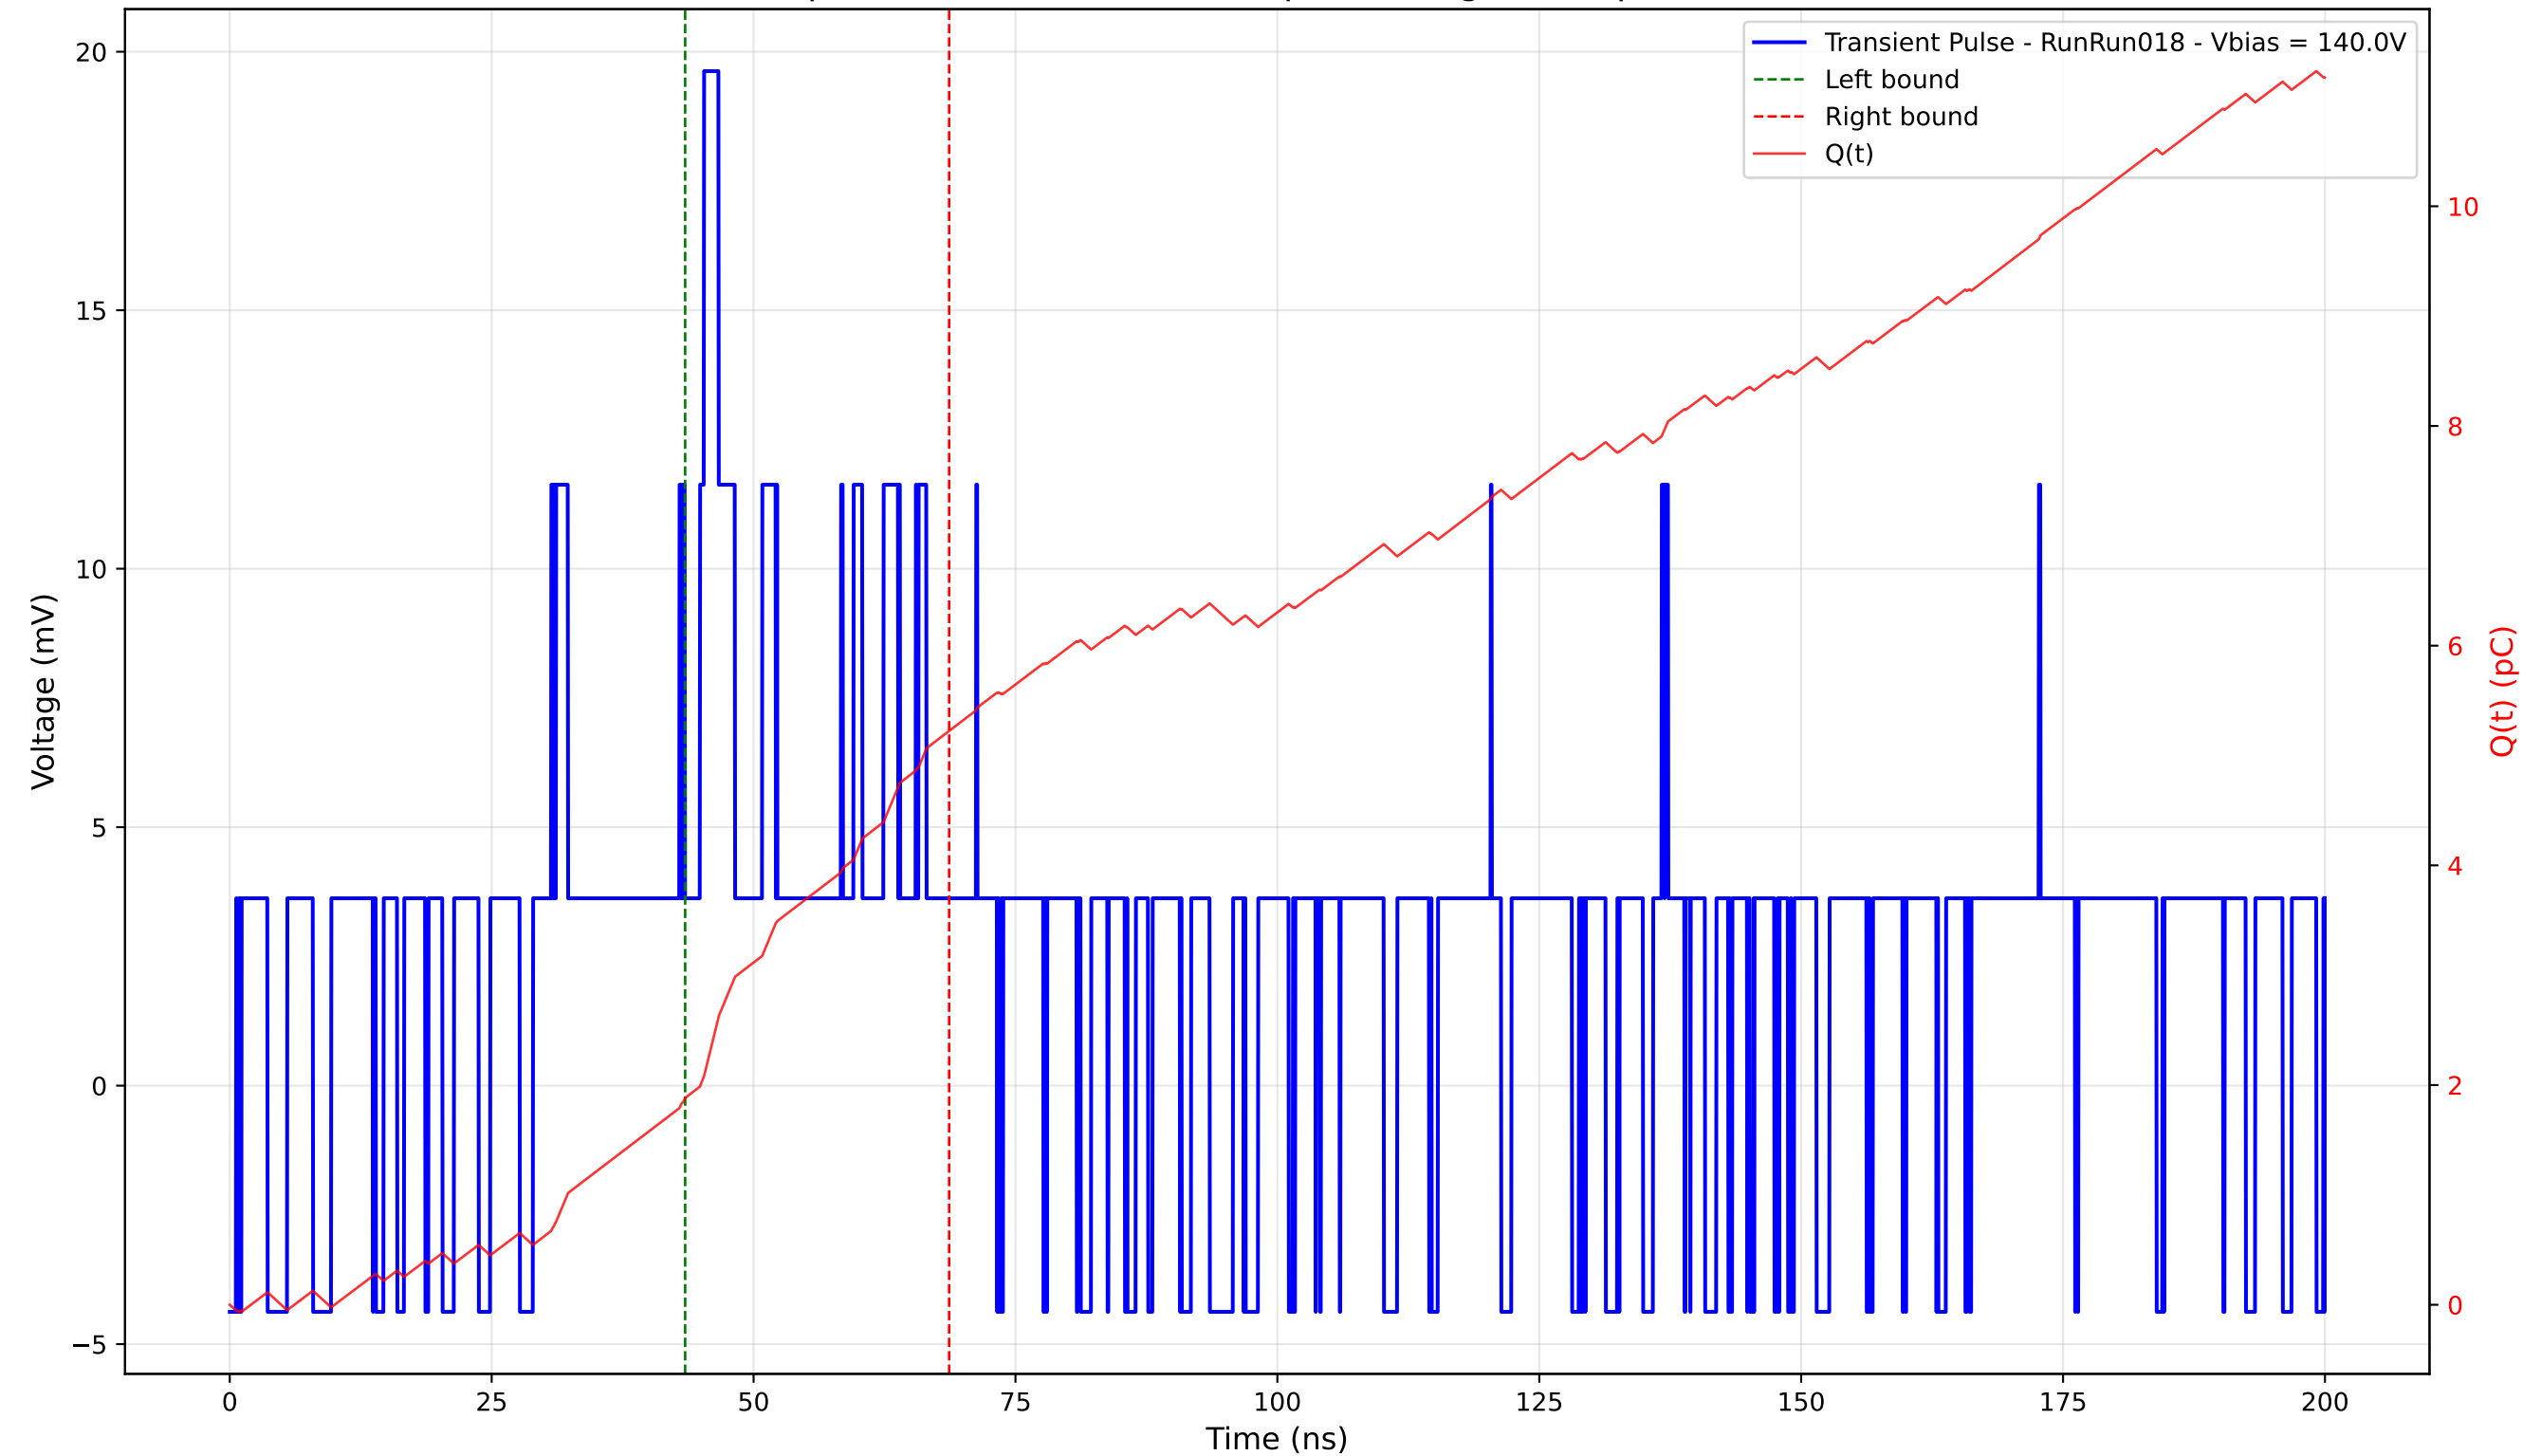

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 3.35 pC - Rise Time: 0.00 ns (N/A)

