



TCT Run Run019 Summary

Parameter	Value
Run	Run019
Surface	N/A
Edge	x
Sample	4003
Vbias (V)	130.0
DAC (%)	63.0
Bandwidth	500MHz
Path	C:\Users\APD-I\Desktop\TCT\EdgeTCT\080526\130V_63DAC
Irradiation (Fluence)	N/A
Notes	N/A
Date	N/A
Gain Constant	N/A


Collected Charge

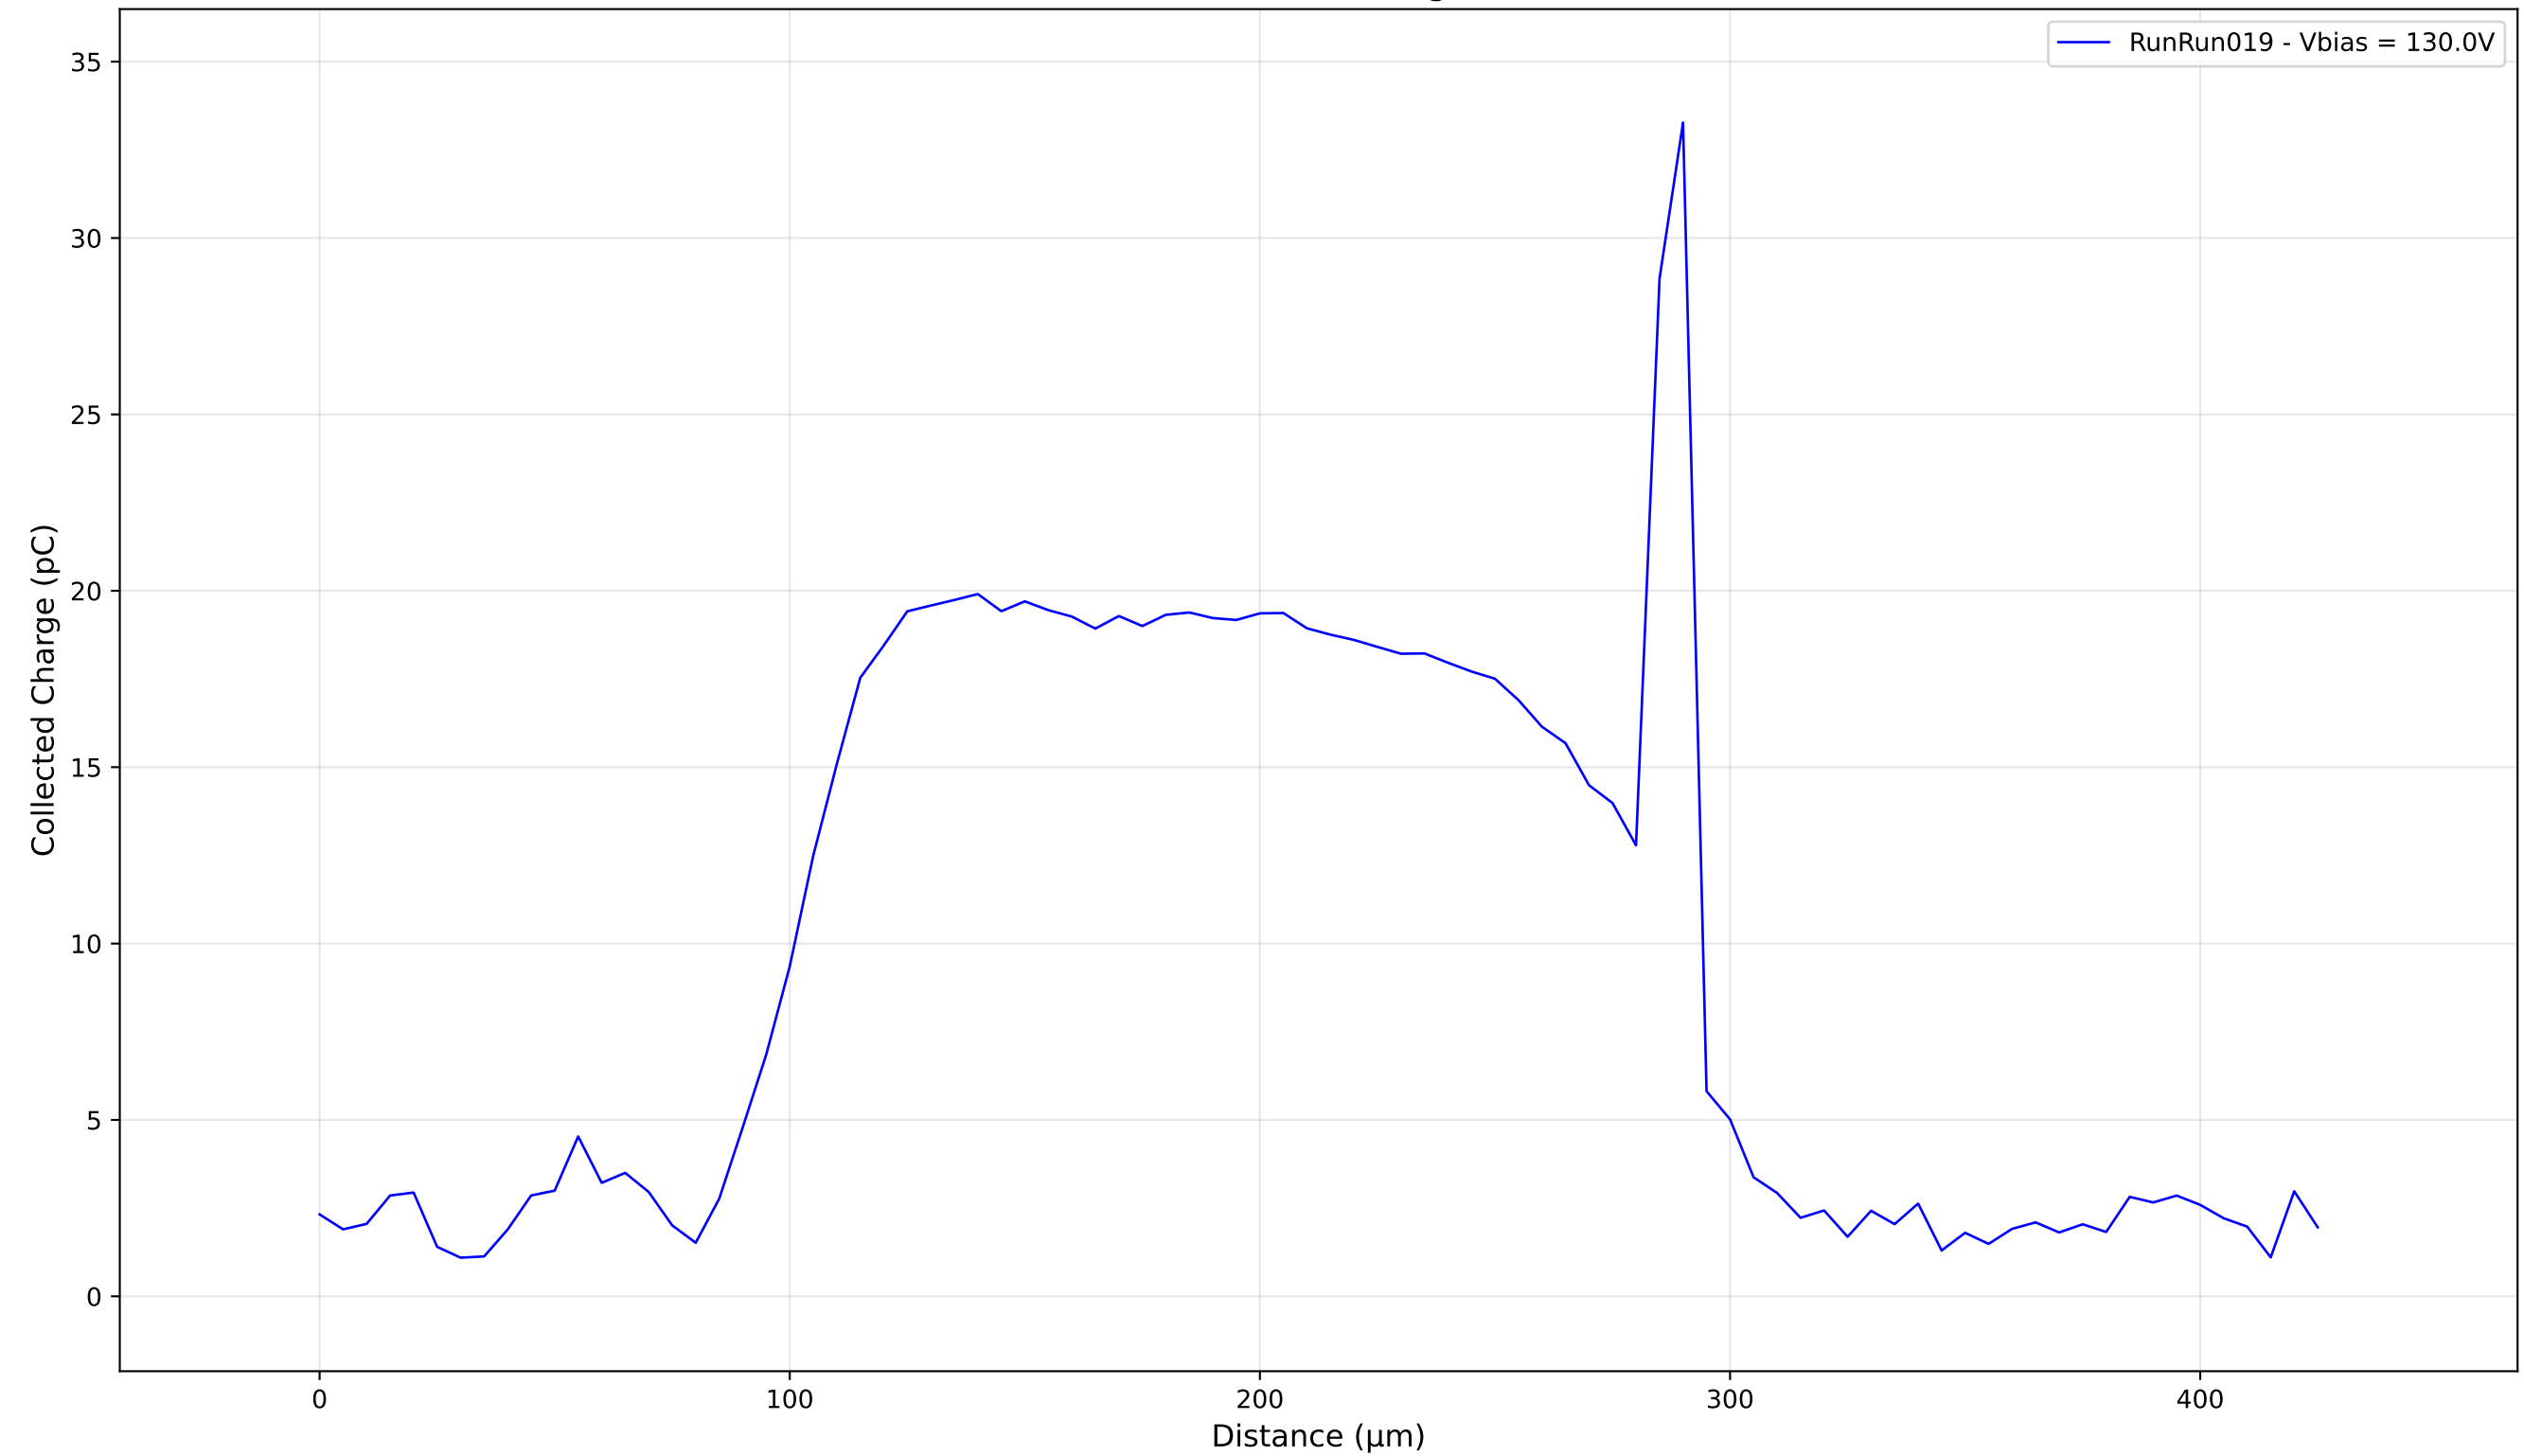


Collected Charge

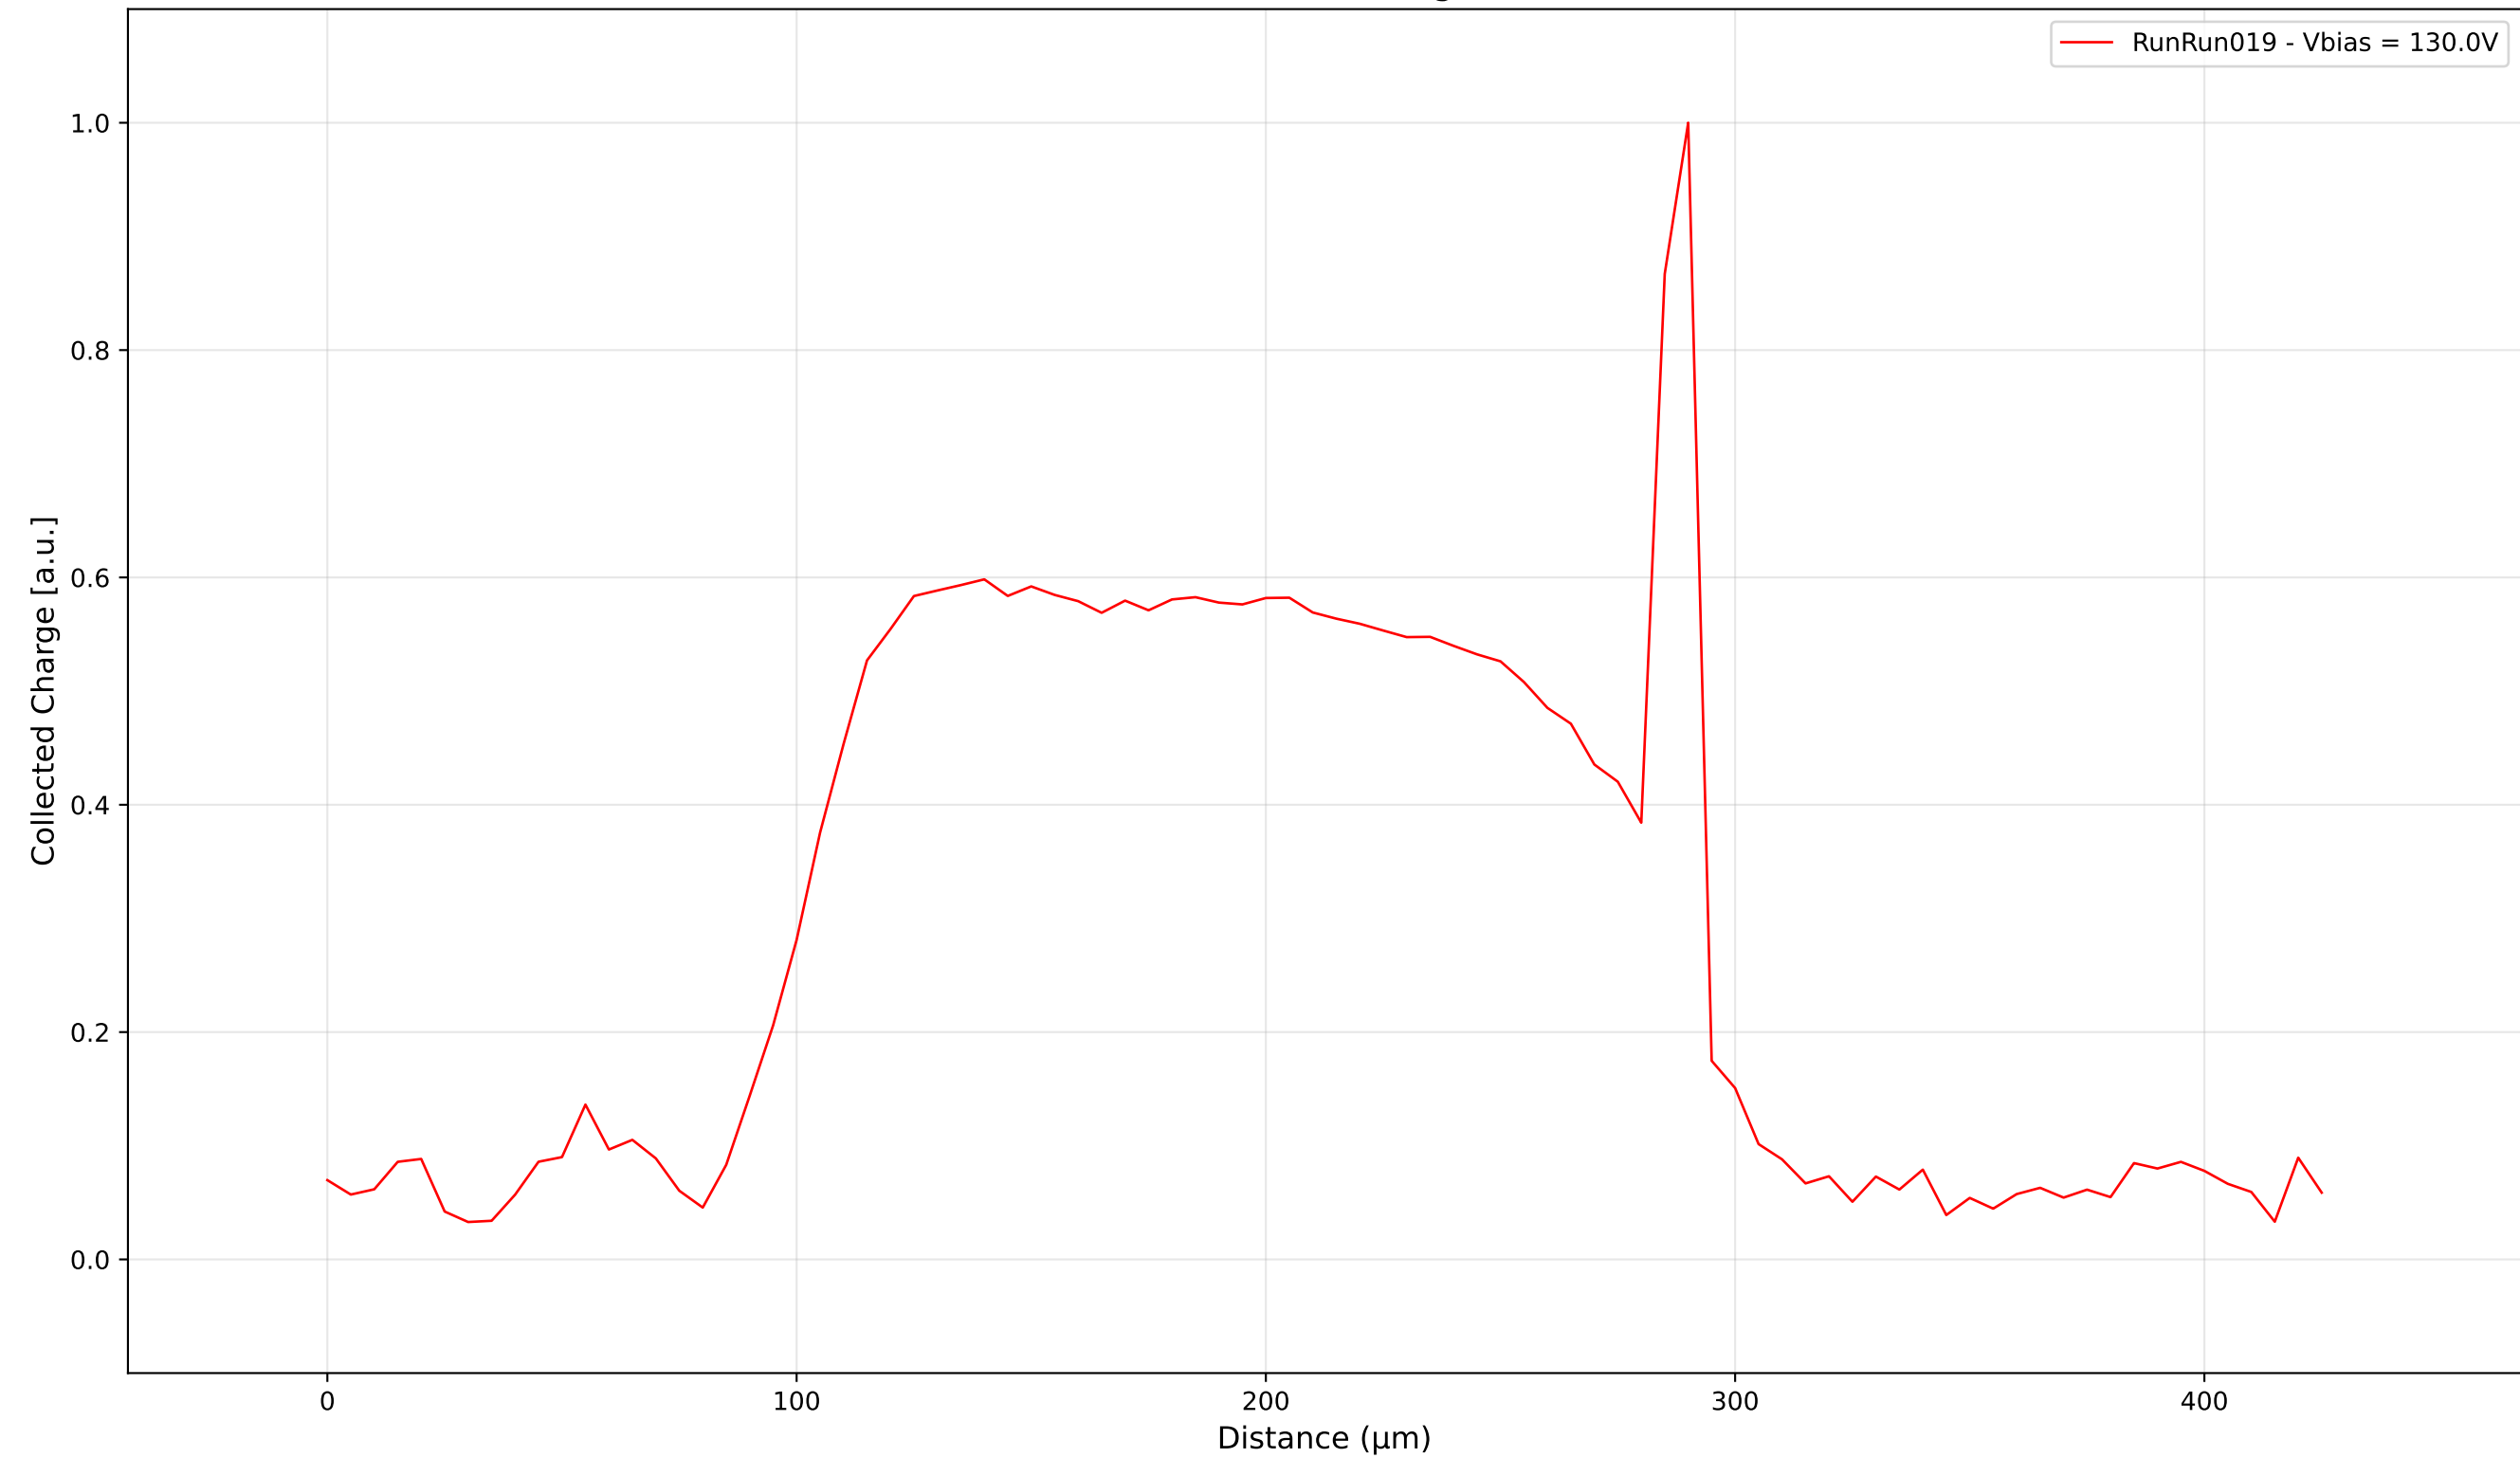


Rise Time

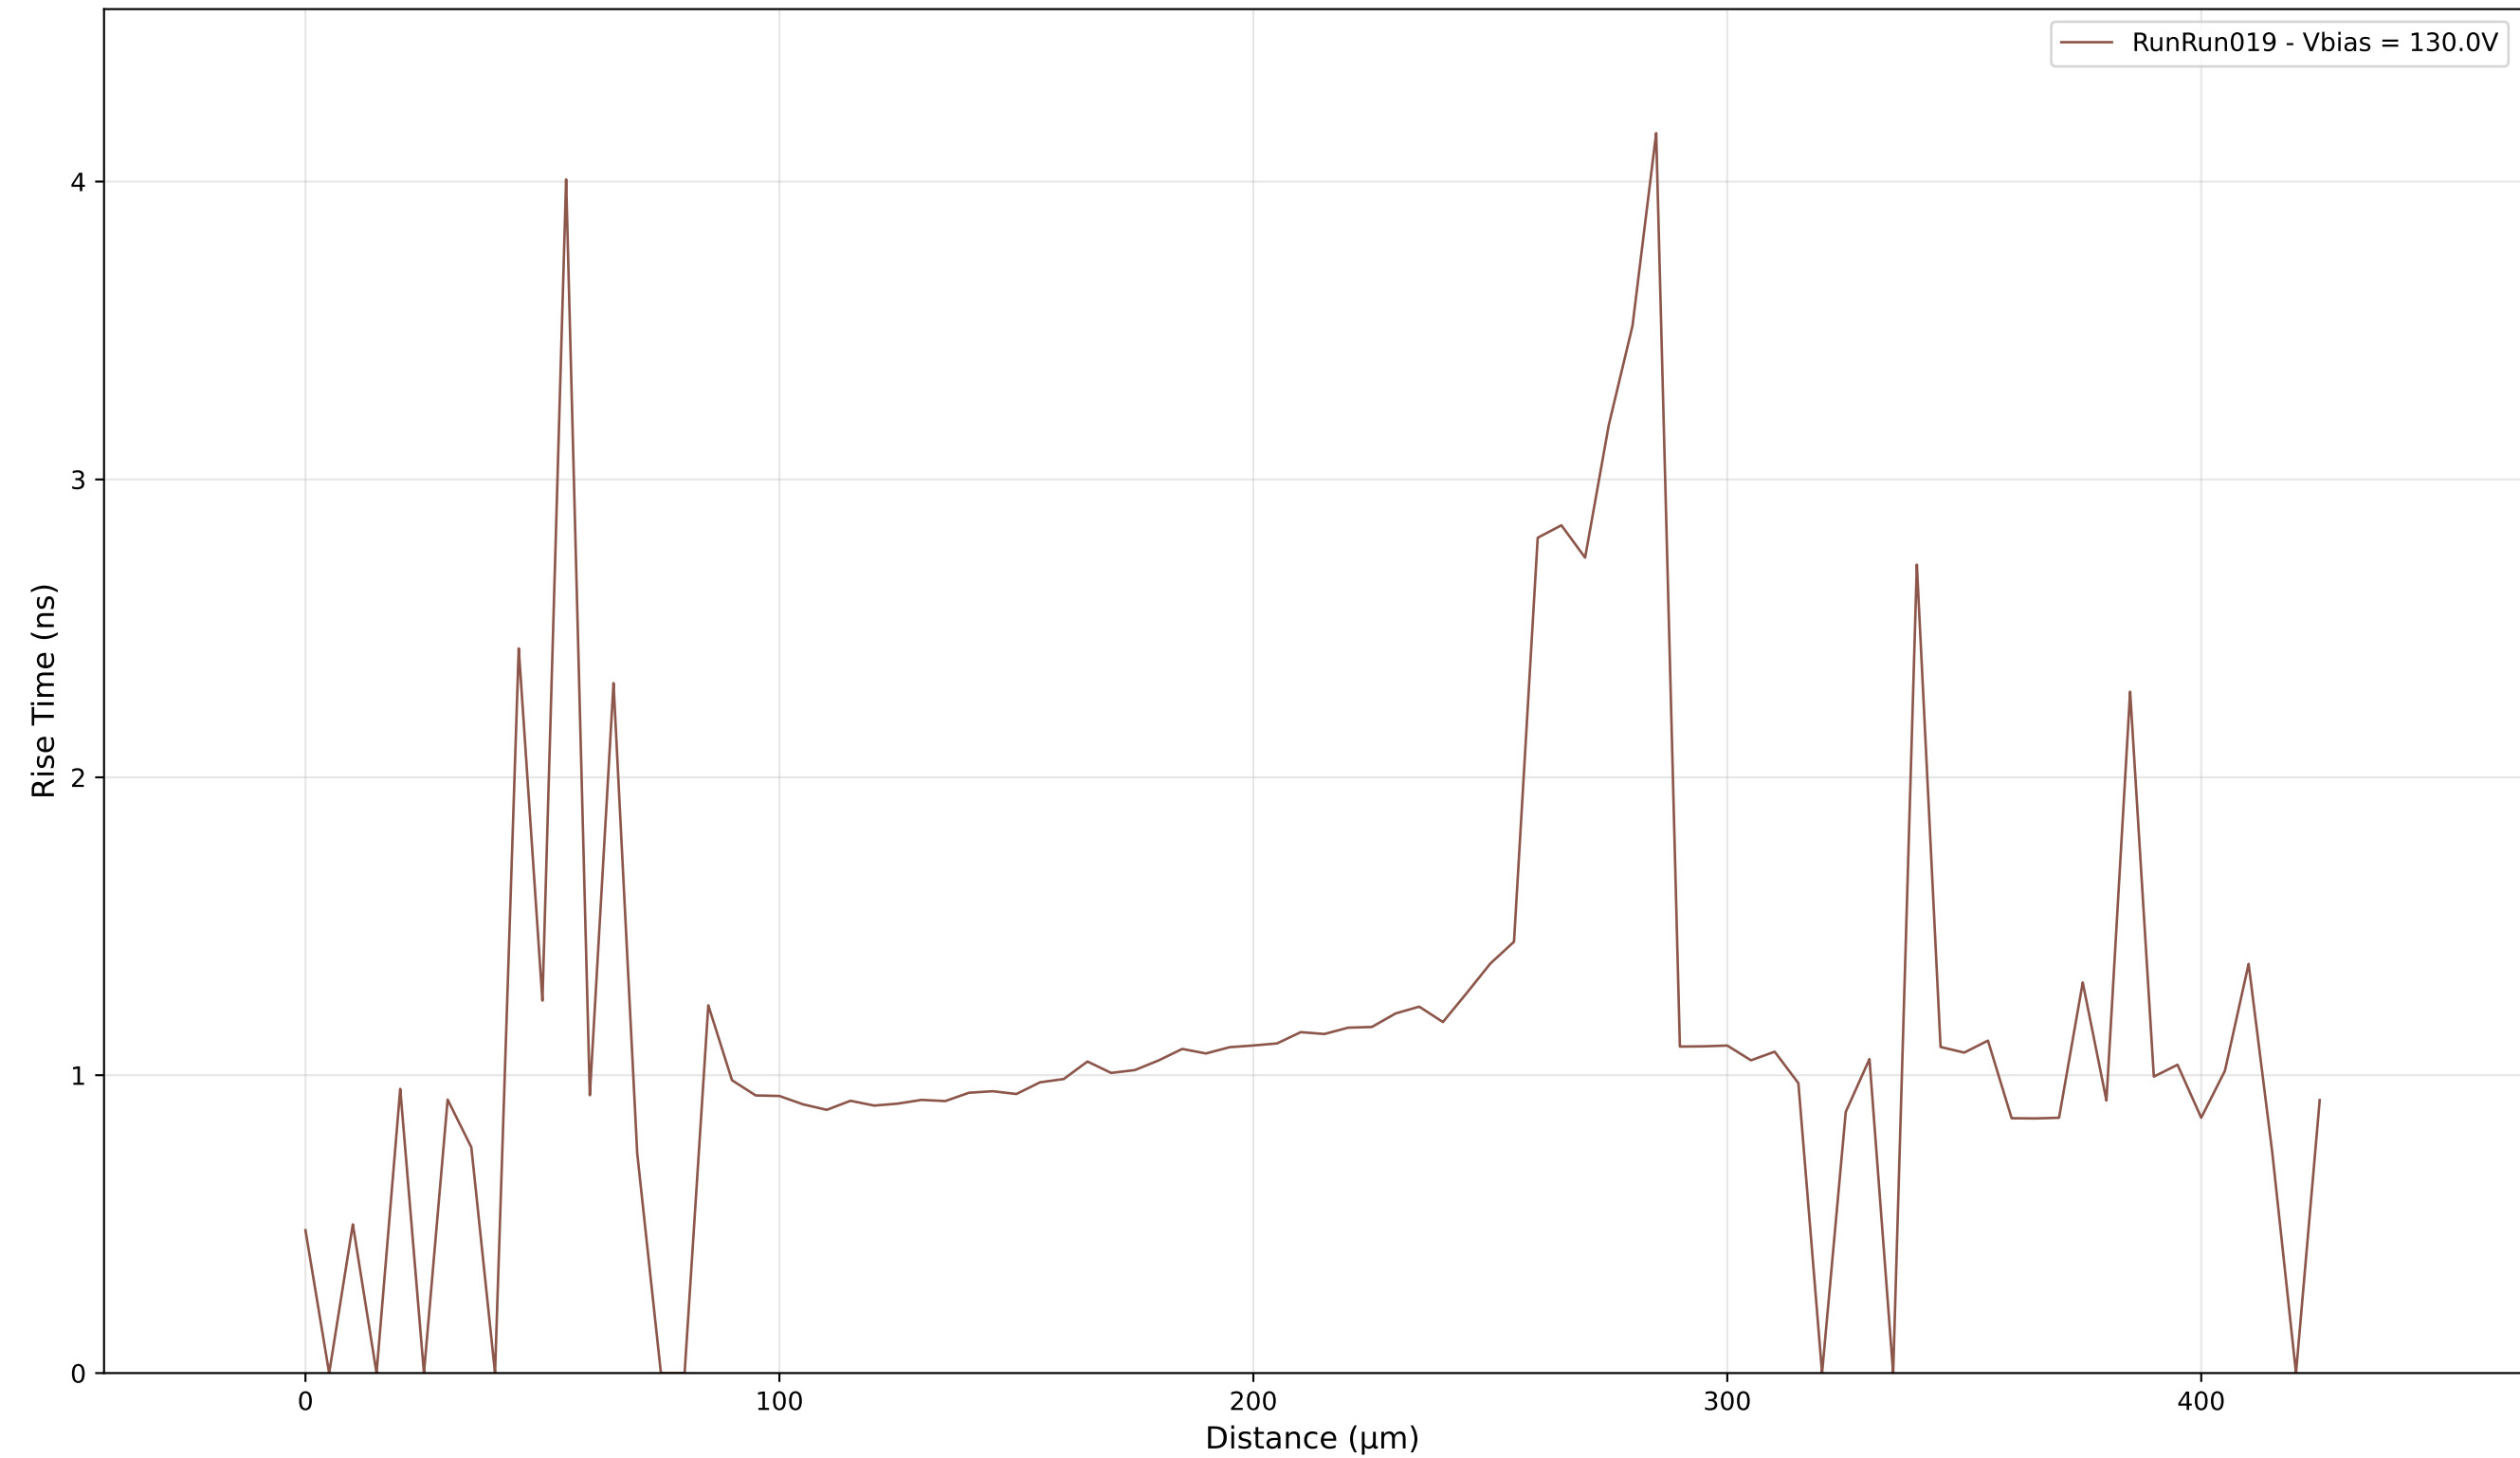


Amplitude

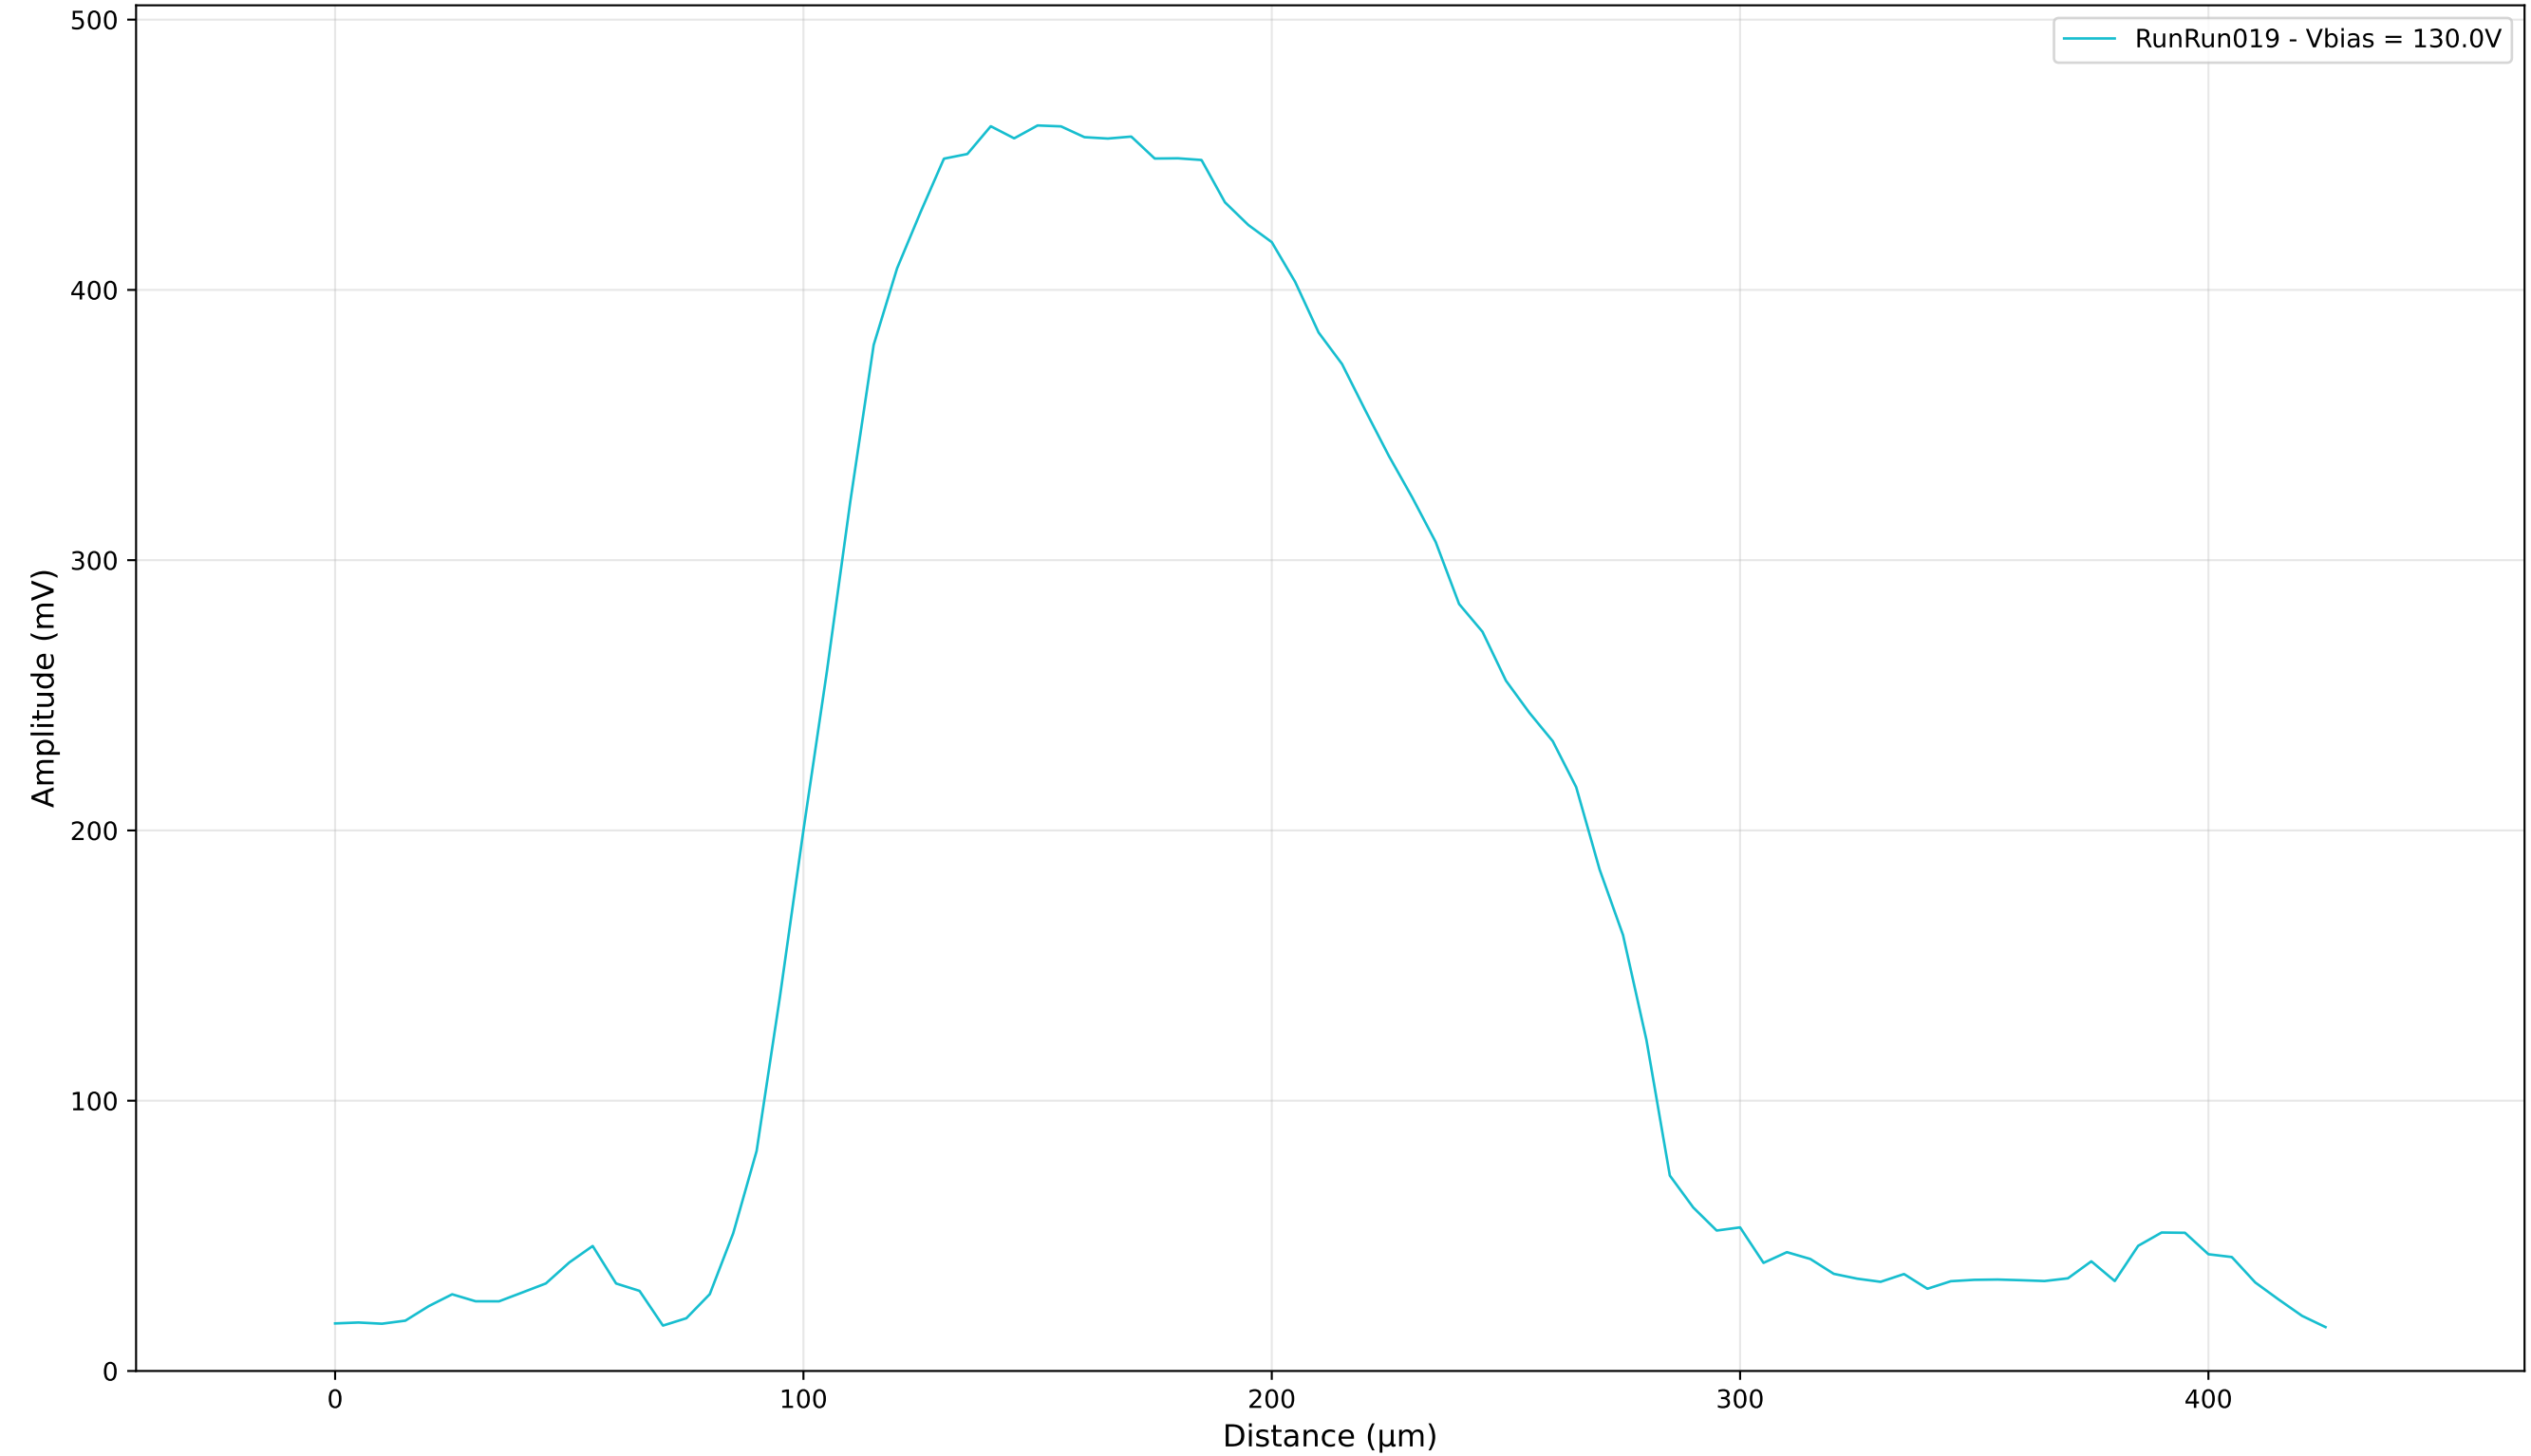


FWHM

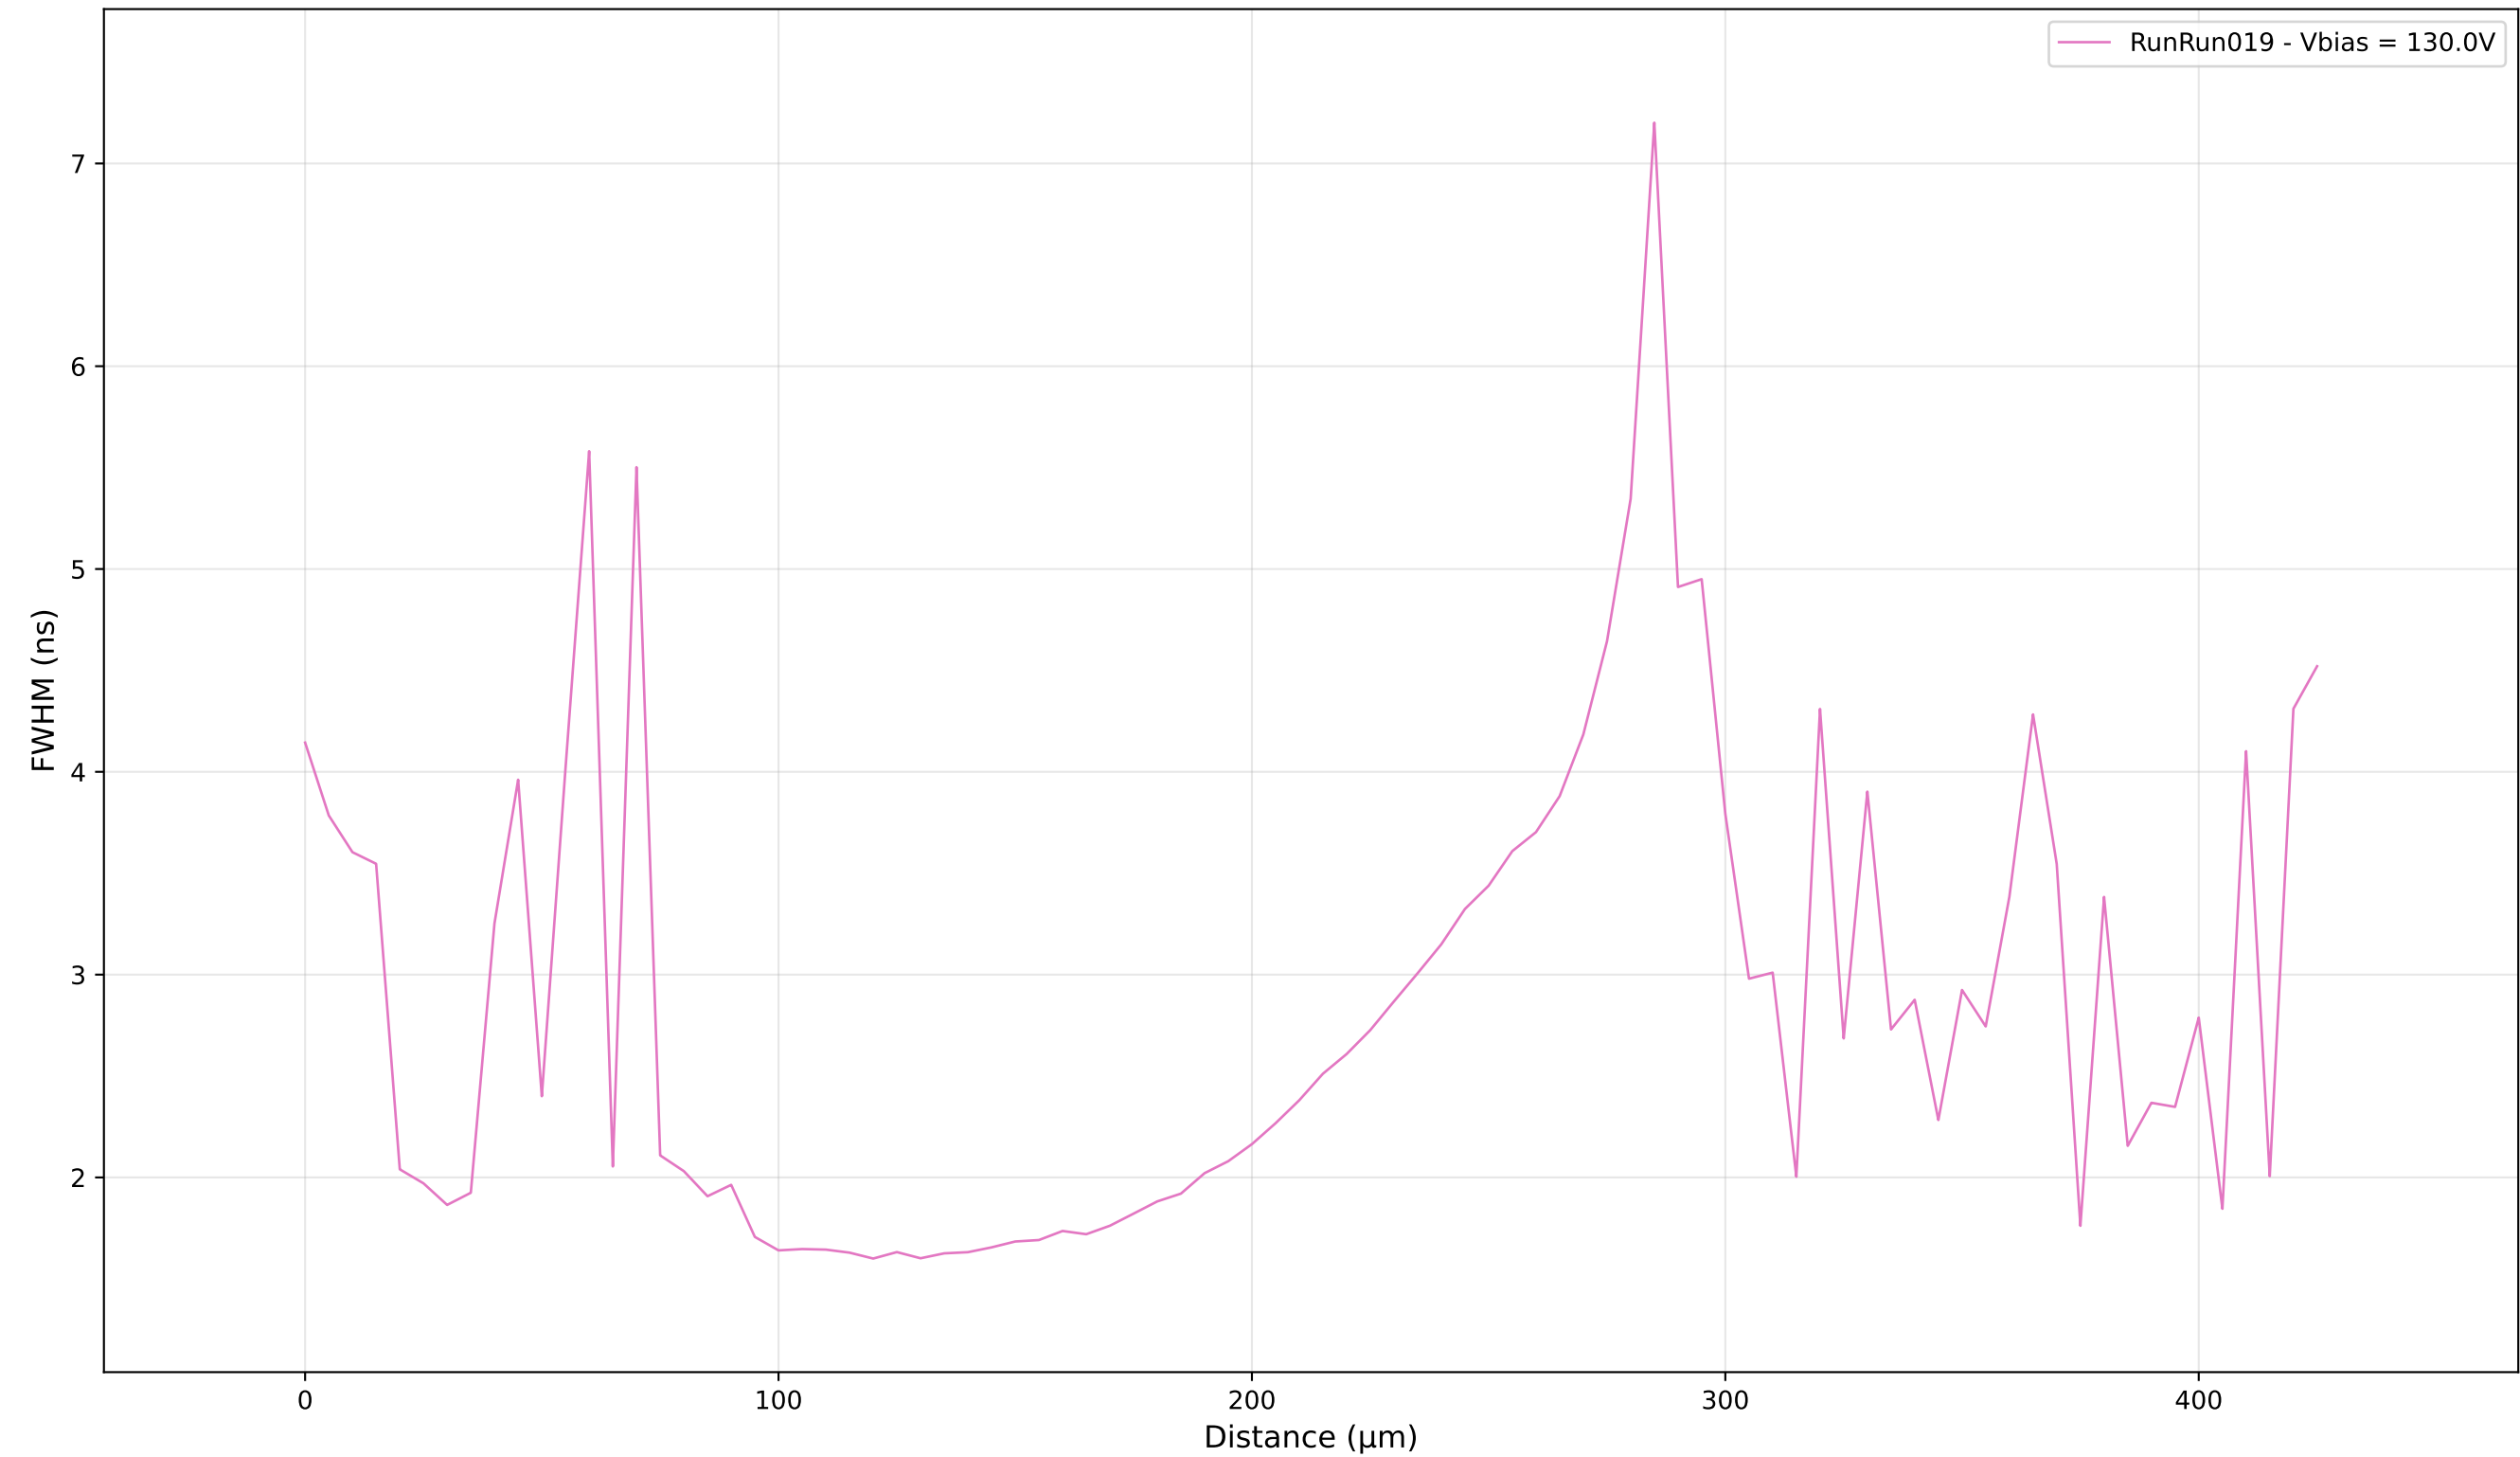


Transient Pulse - Sample: 4003 - Position: 0.0 μm - Charge: 2.32 pC - Rise Time: 0.48 ns

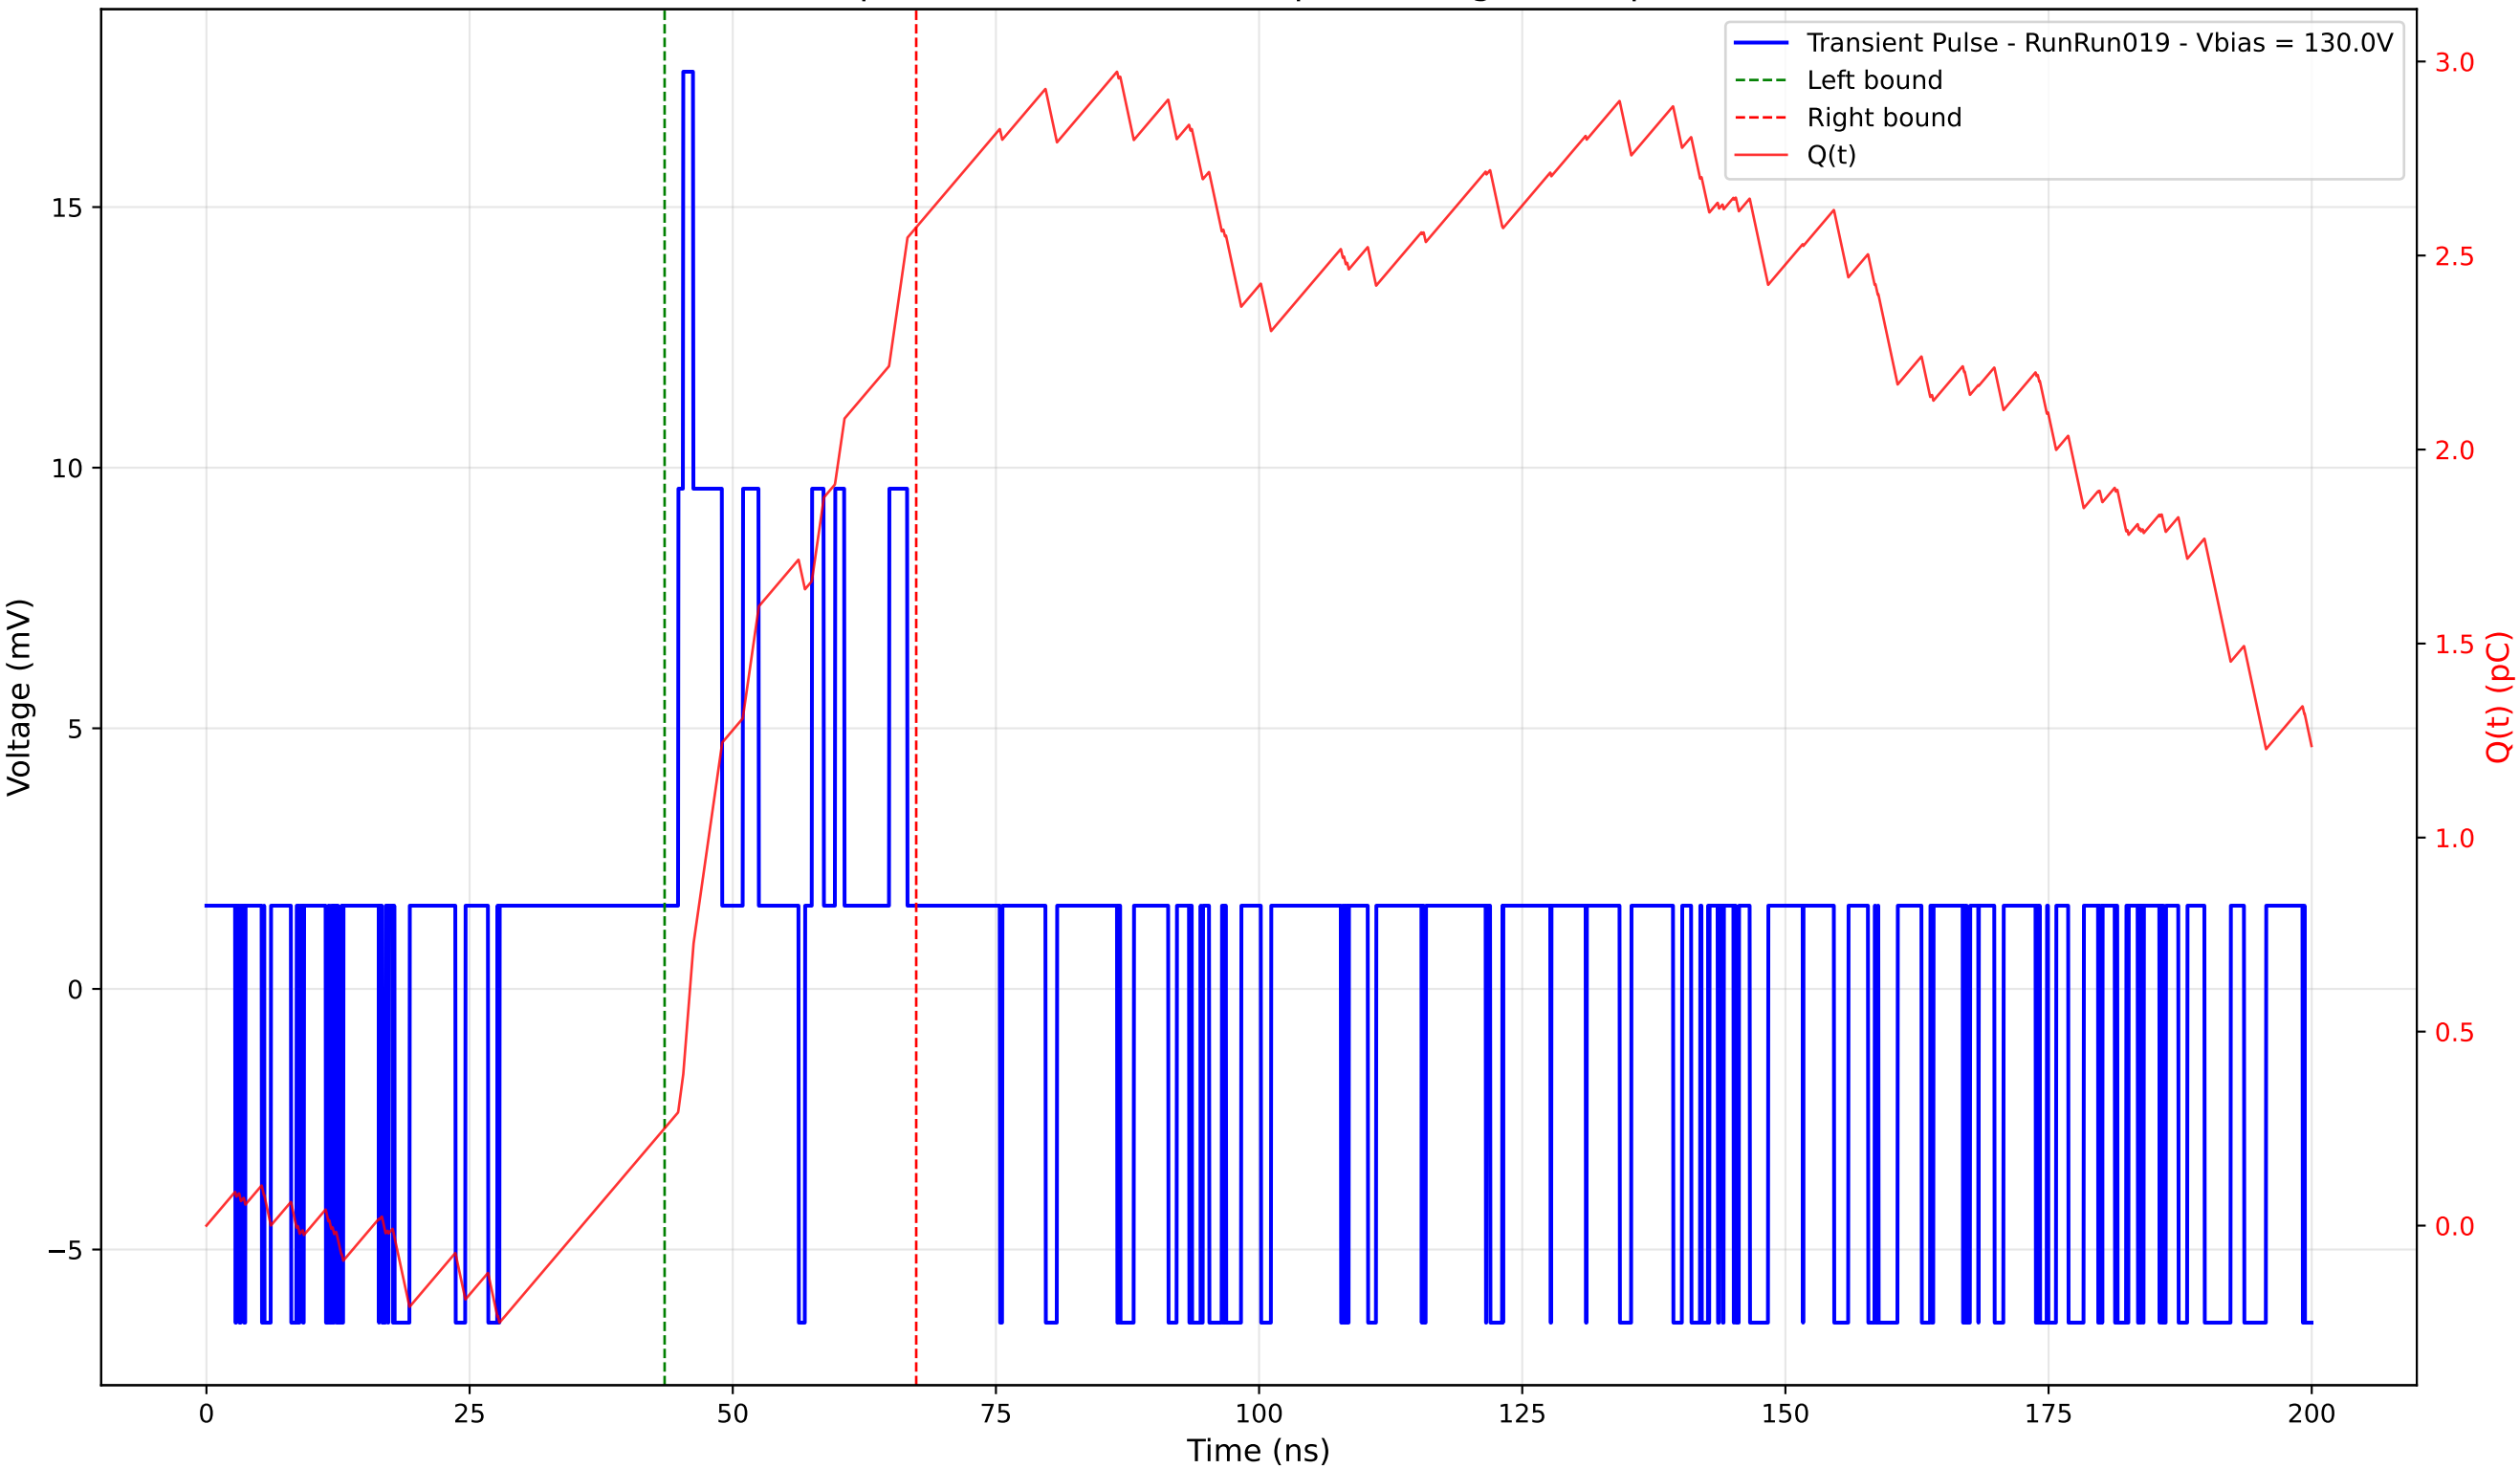


Transient Pulse - Sample: 4003 - Position: 5.0 μm - Charge: 1.90 pC - Rise Time: 0.00 ns (N/A)

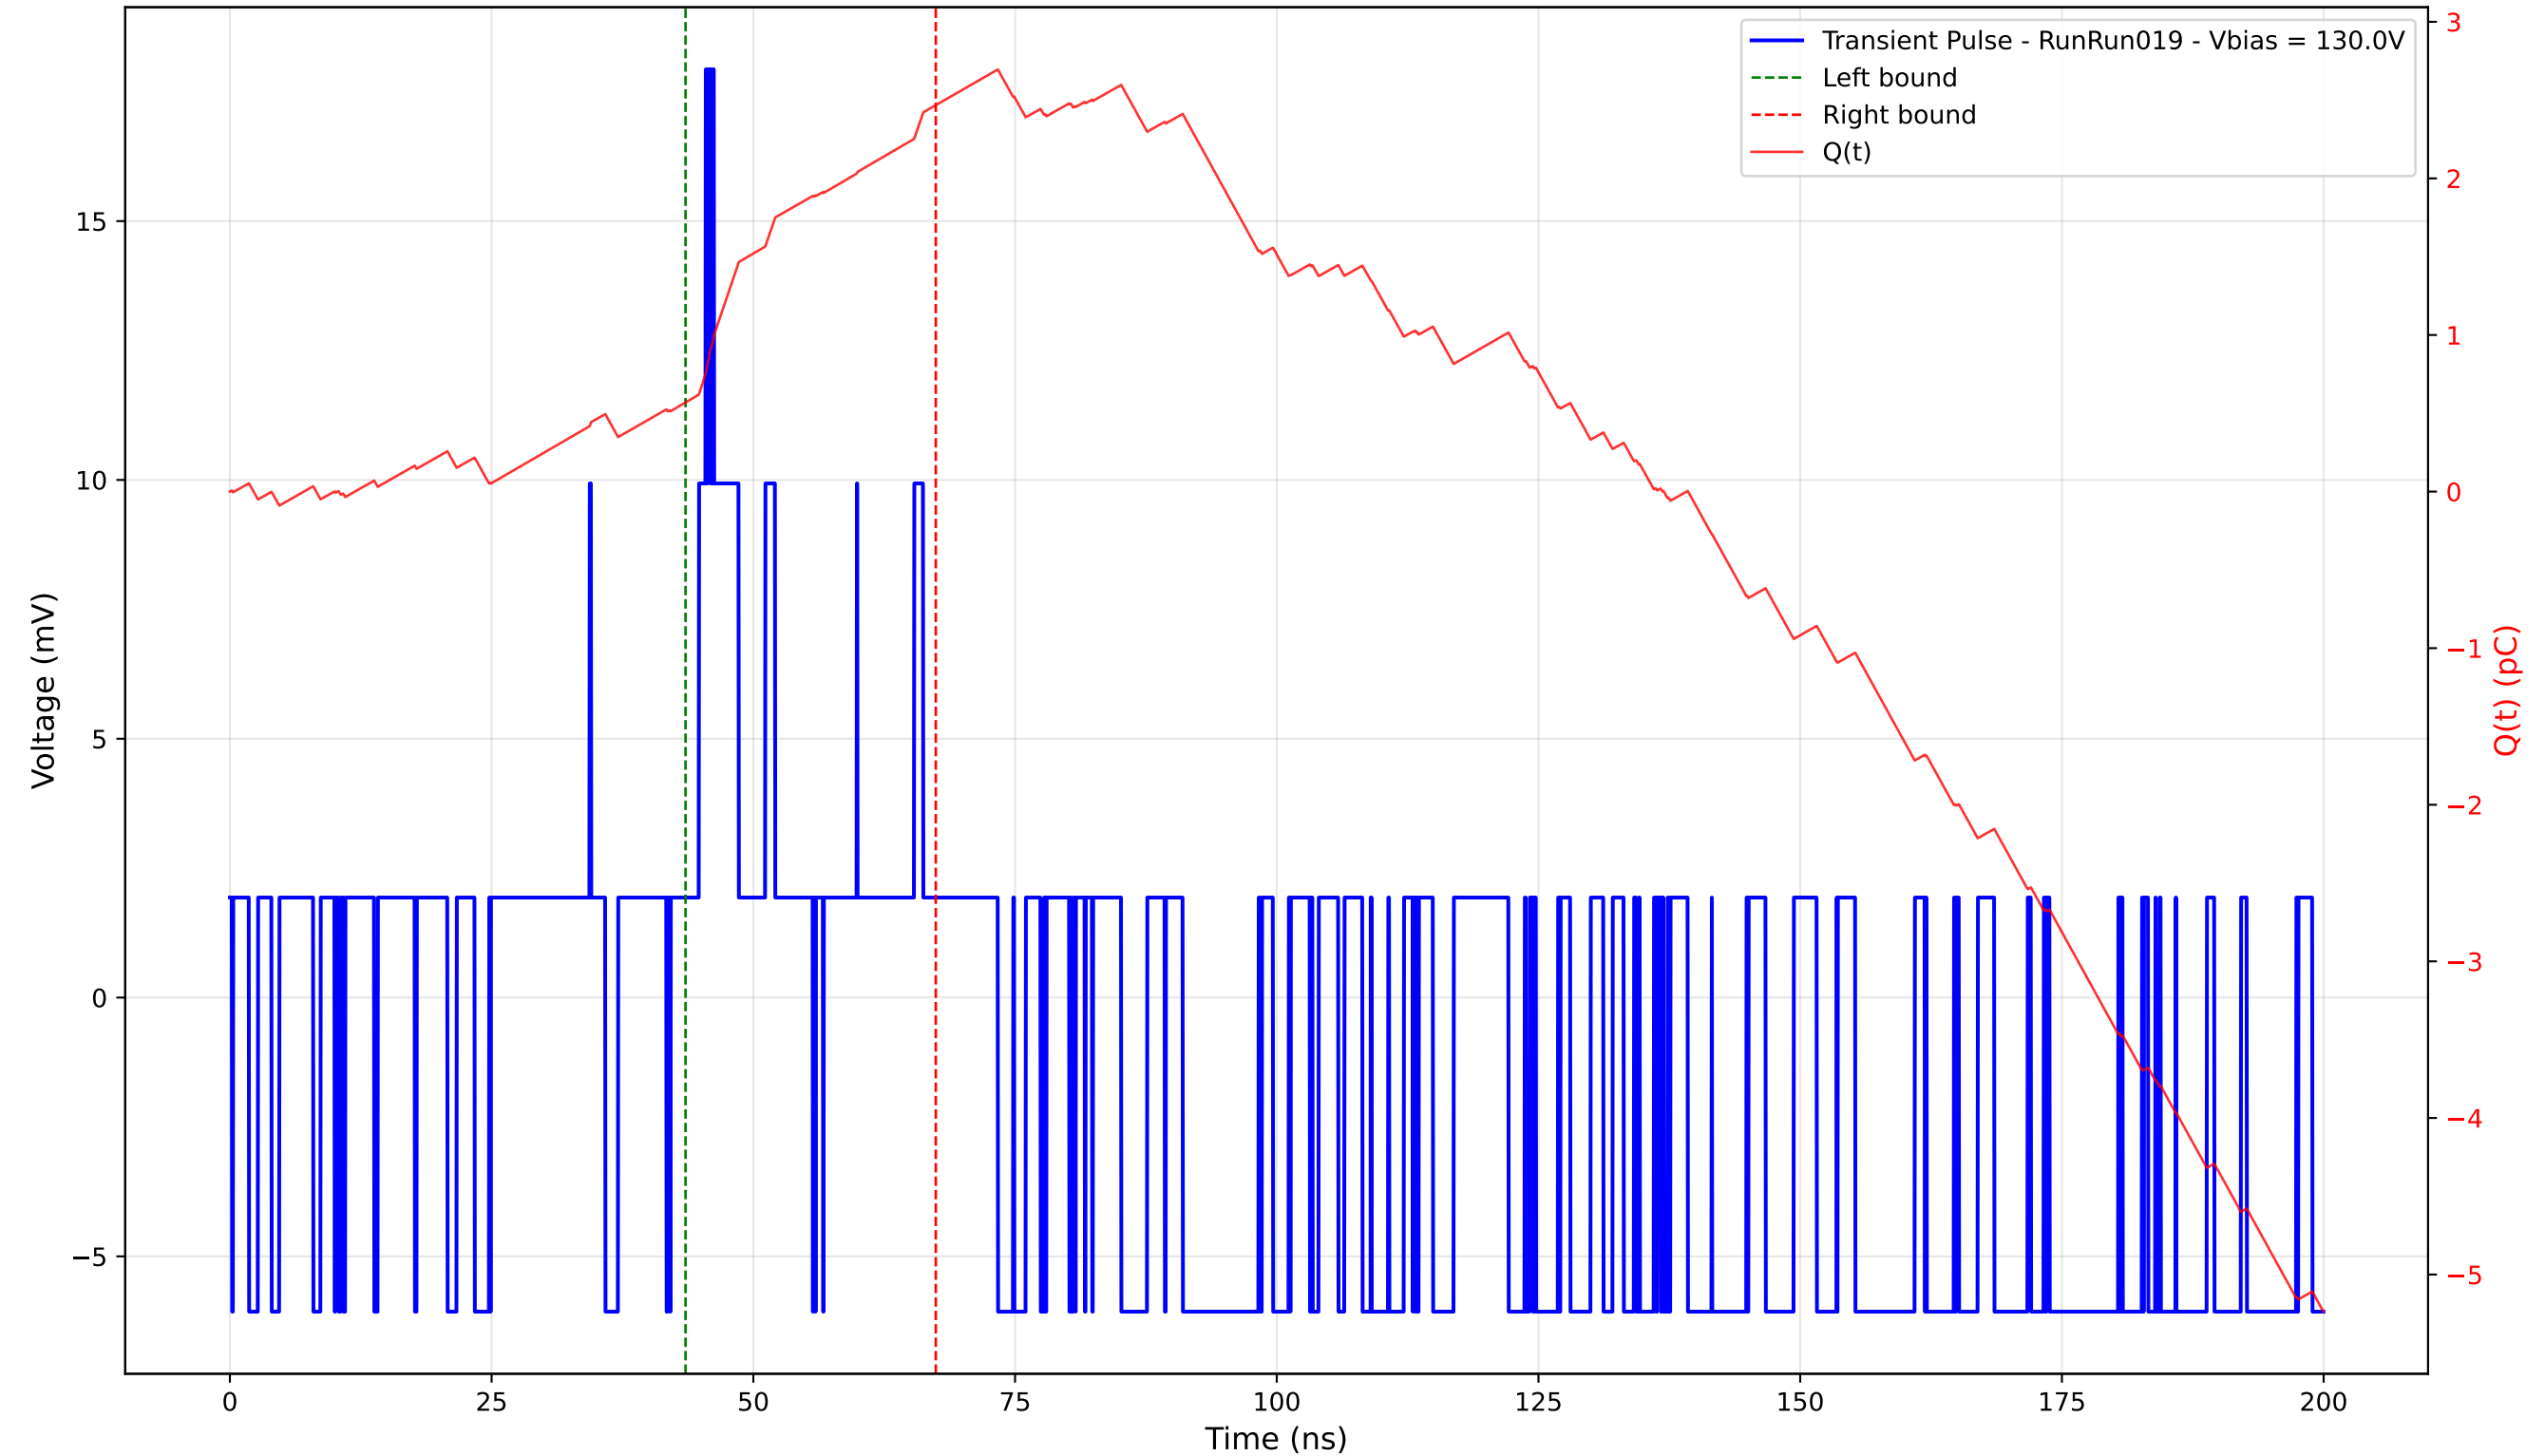


Transient Pulse - Sample: 4003 - Position: 10.0 μm - Charge: 2.05 pC - Rise Time: 0.50 ns

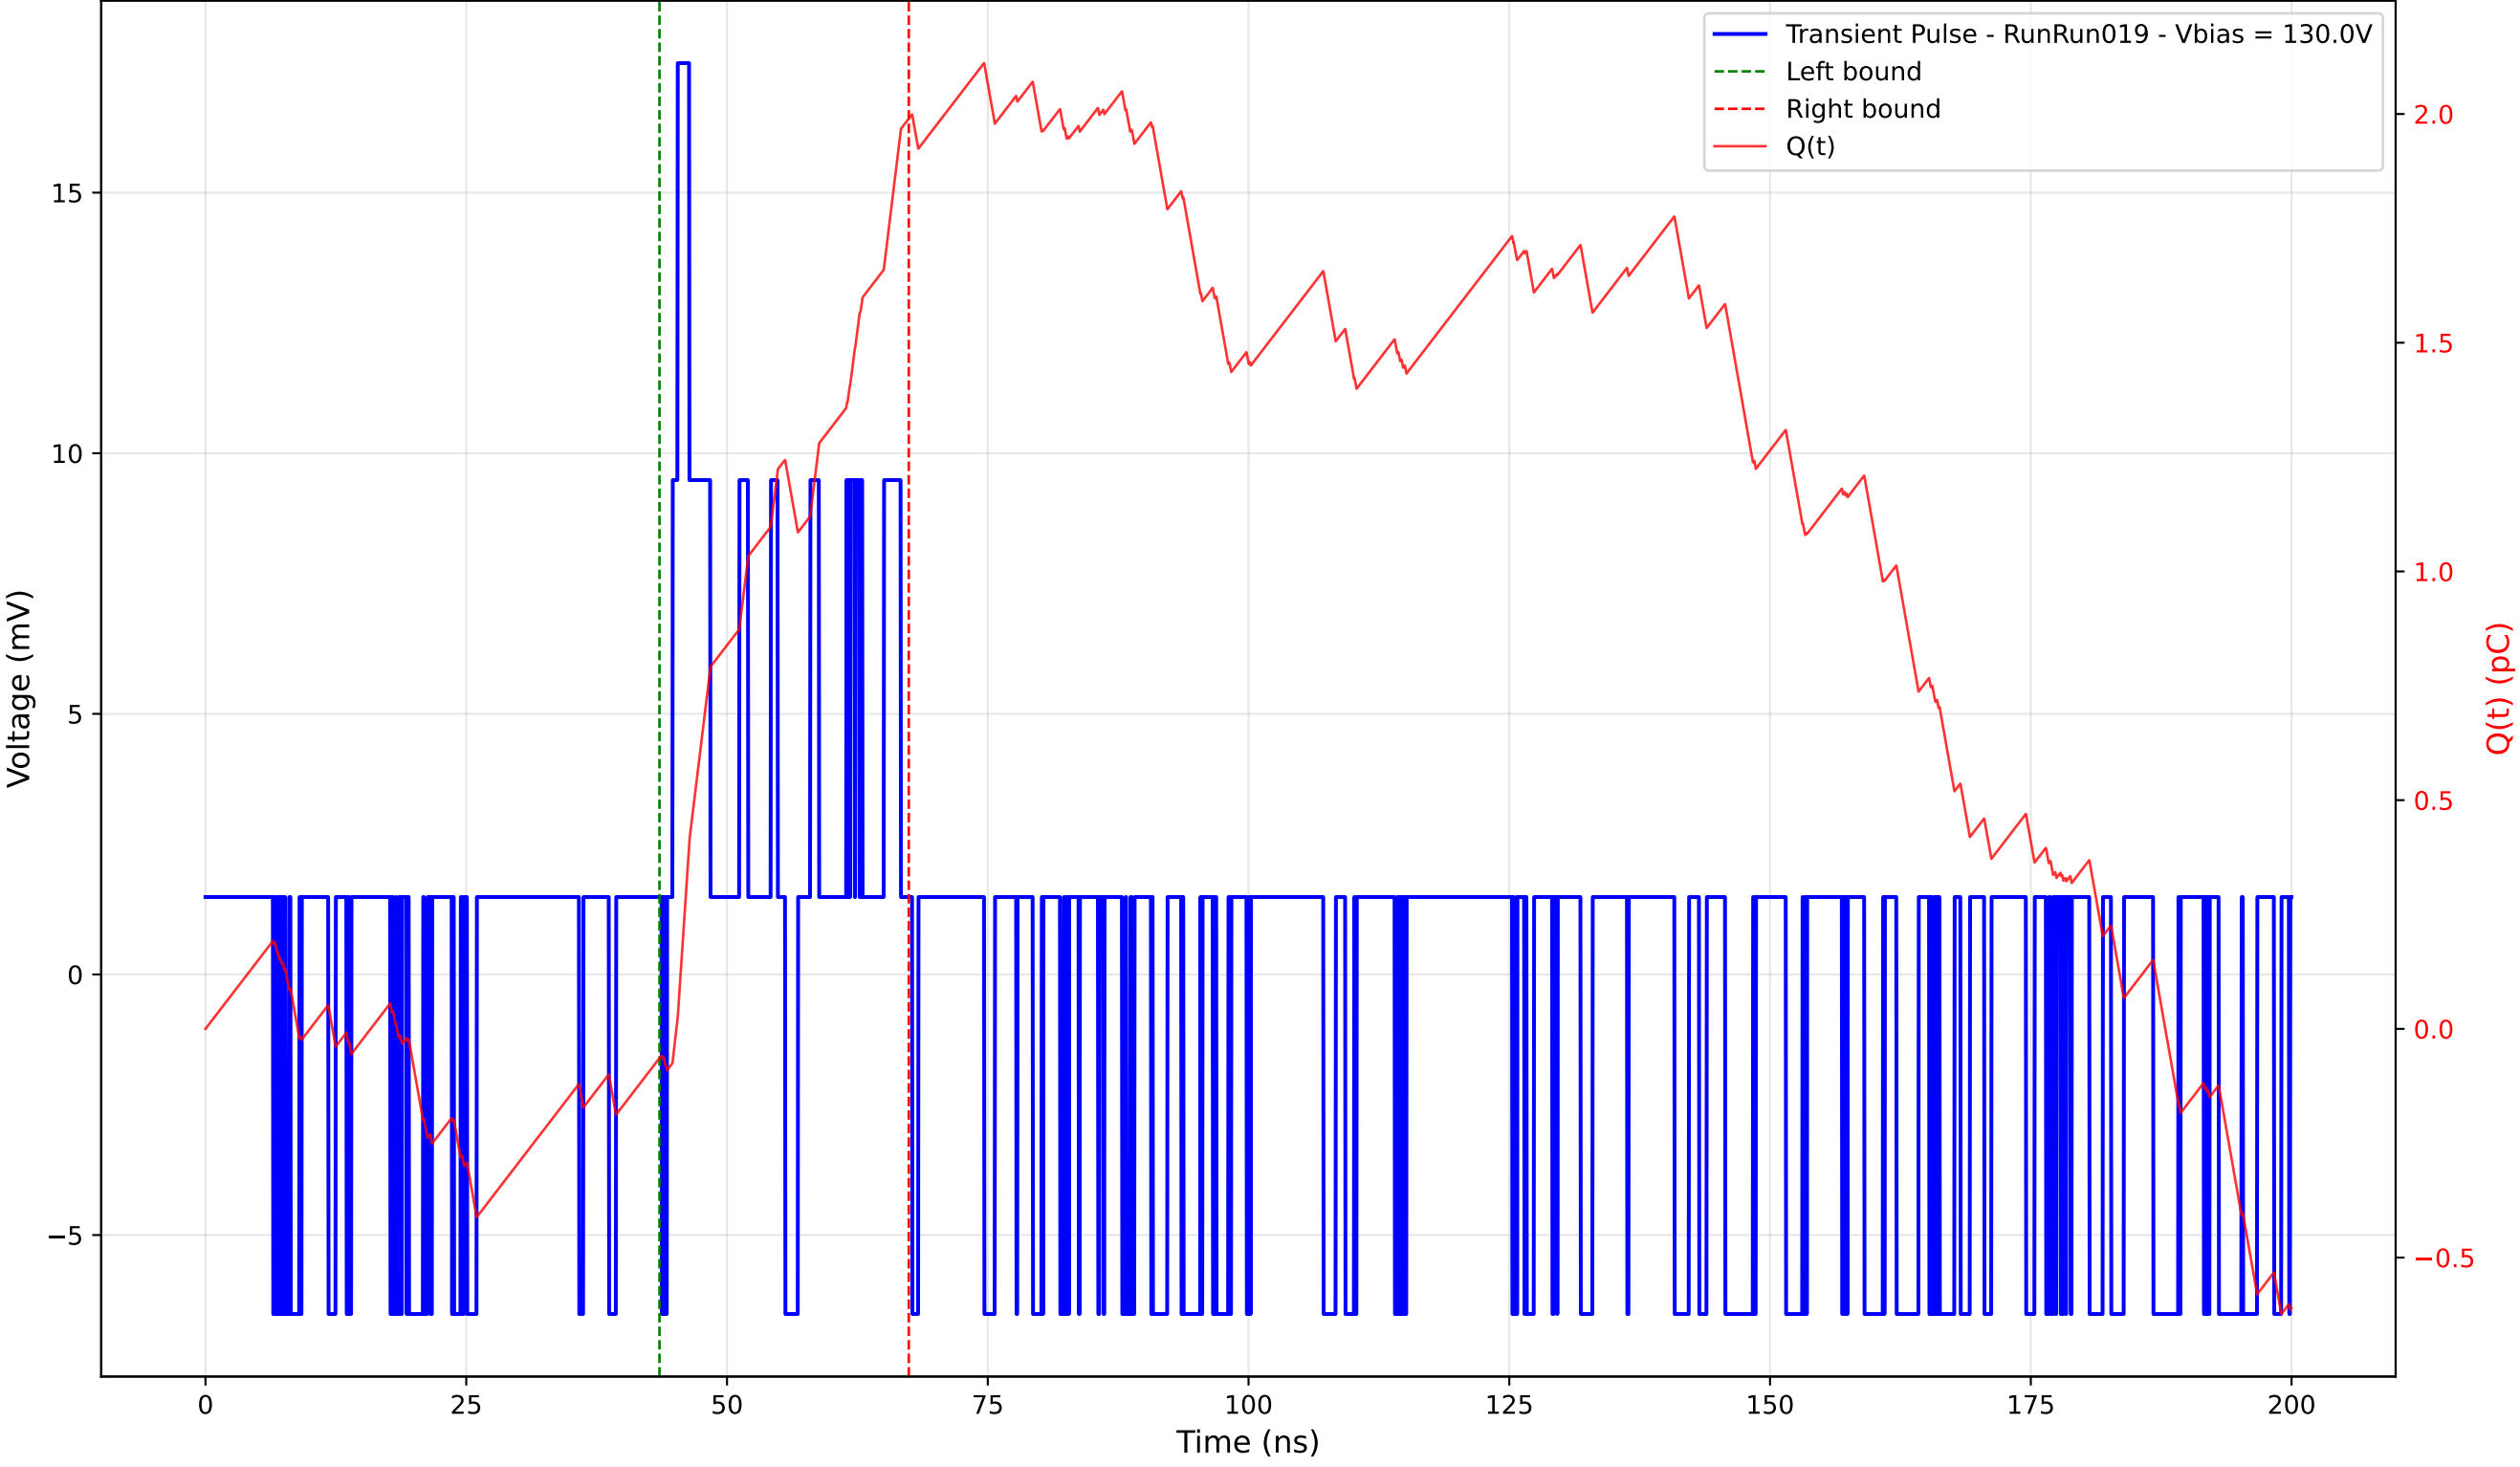


Transient Pulse - Sample: 4003 - Position: 15.0 μm - Charge: 2.86 pC - Rise Time: 0.00 ns (N/A)

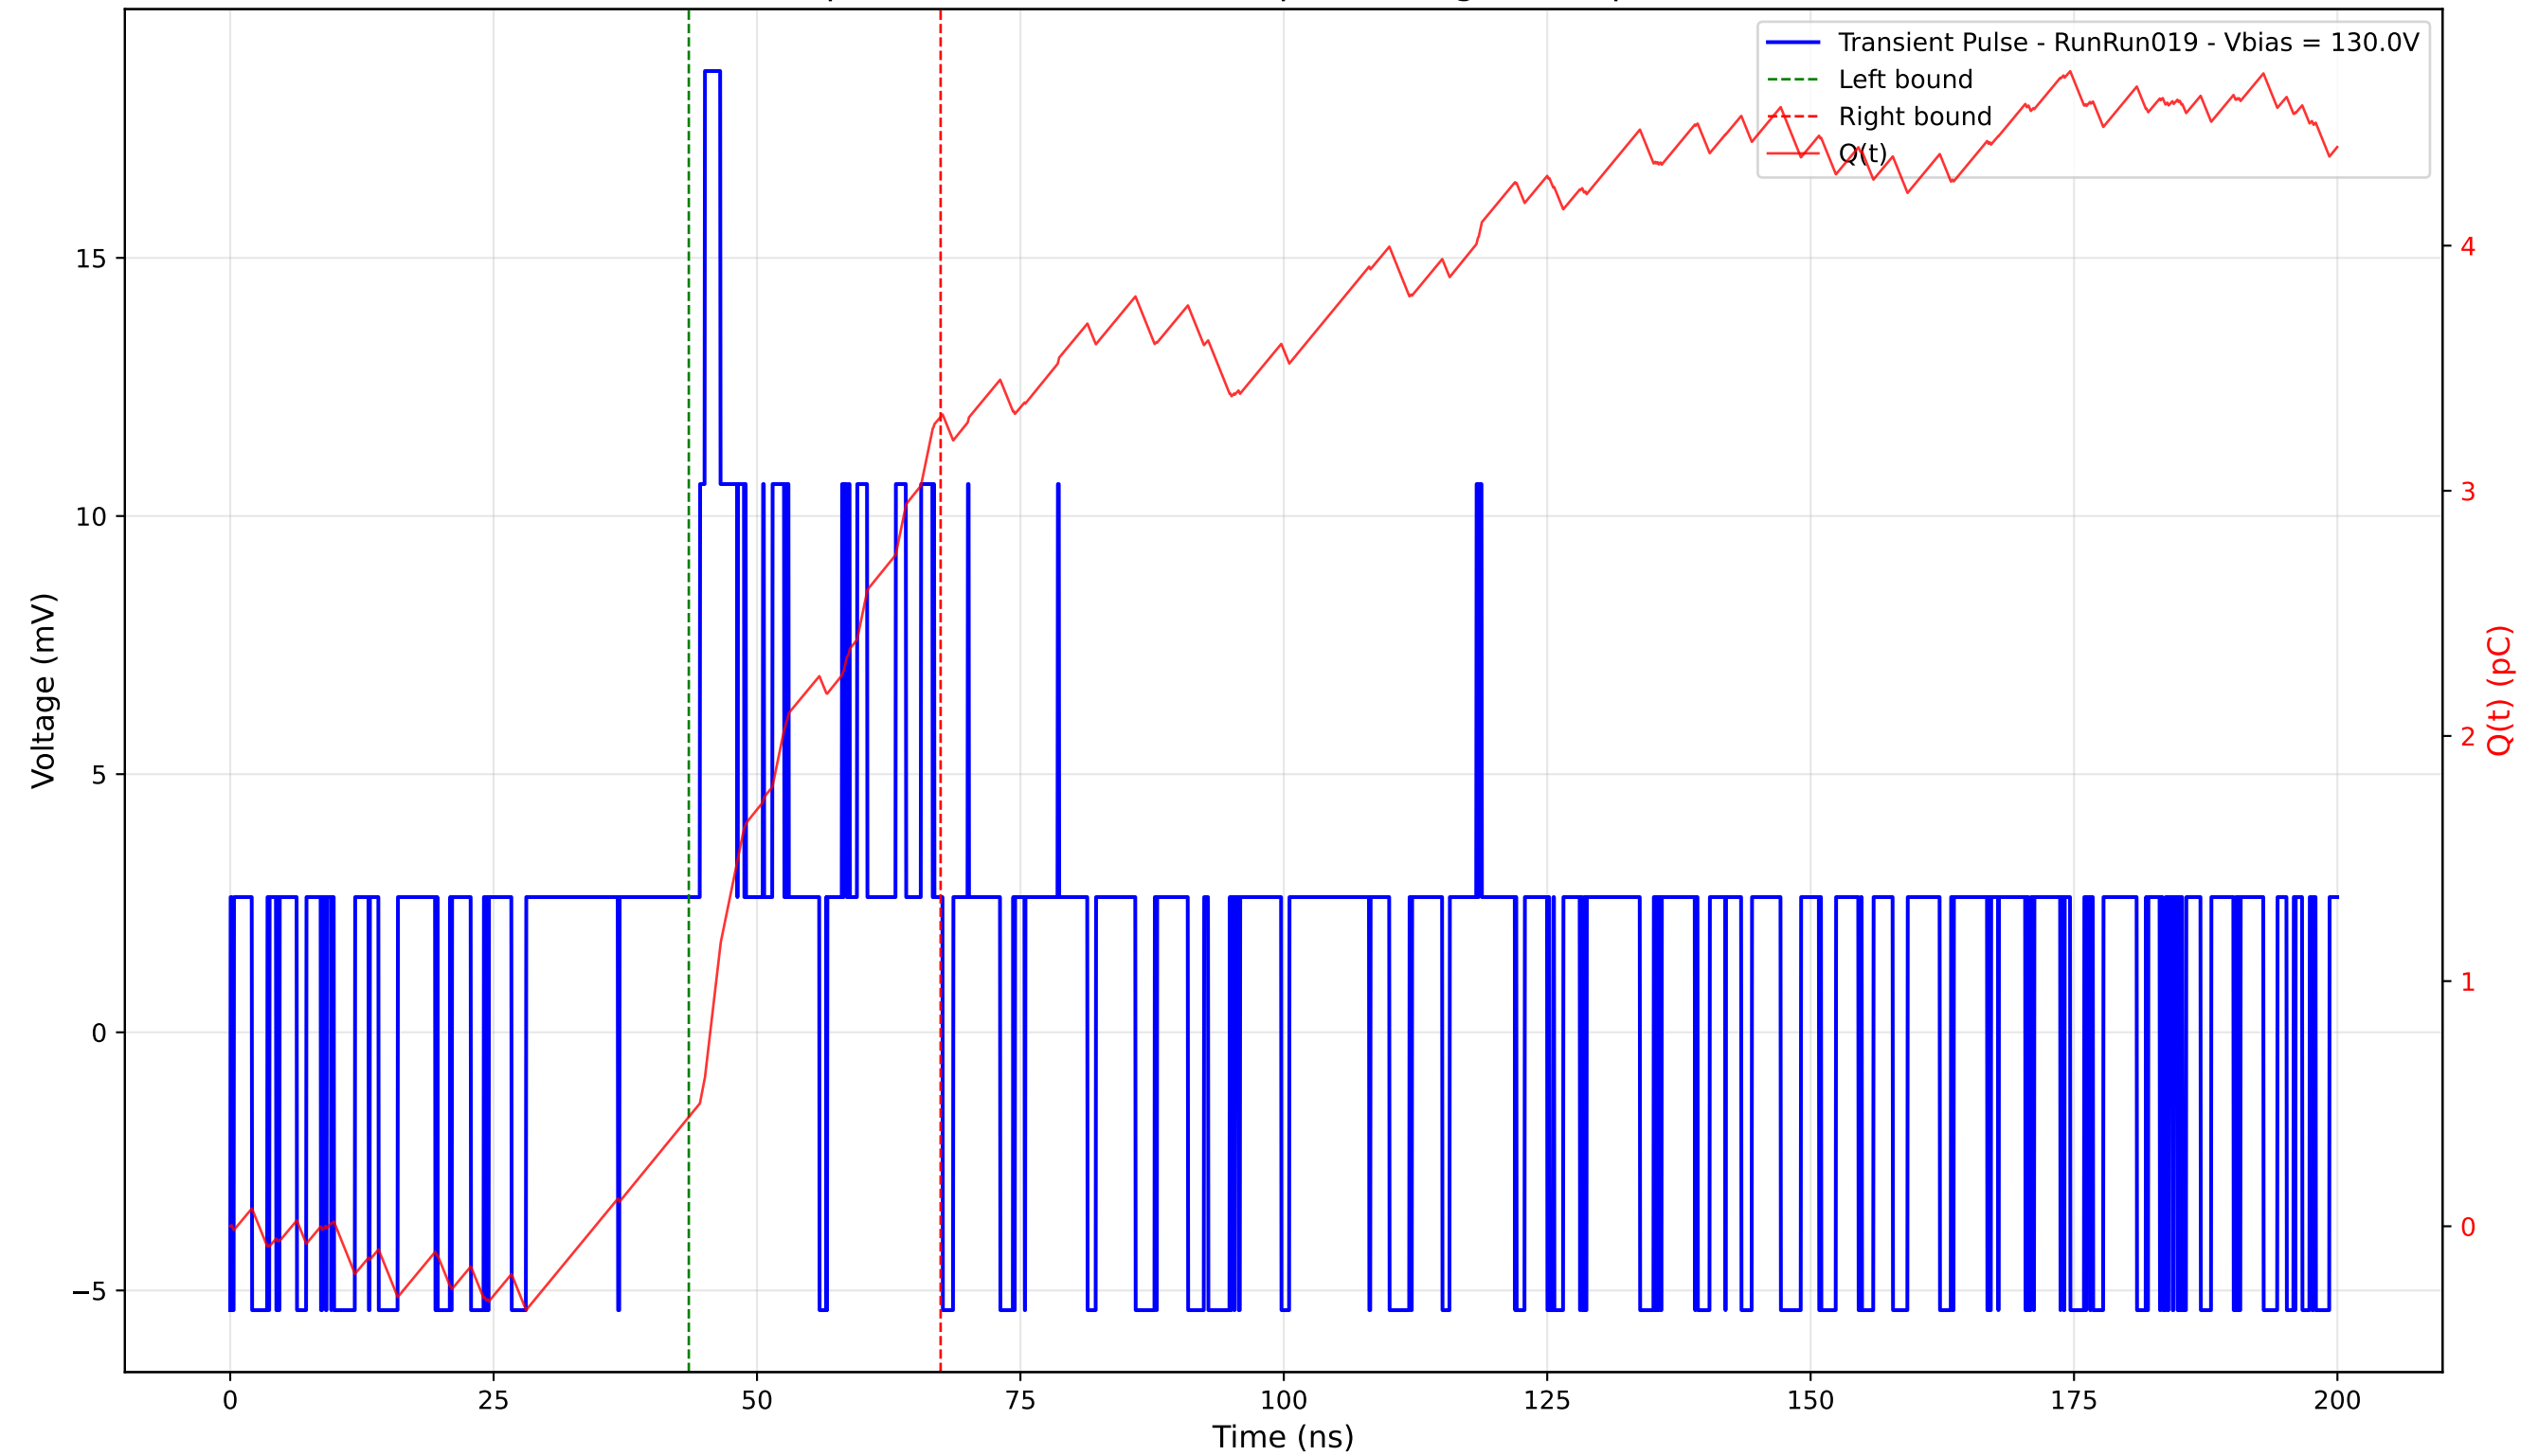


Transient Pulse - Sample: 4003 - Position: 20.0 μm - Charge: 2.94 pC - Rise Time: 0.95 ns

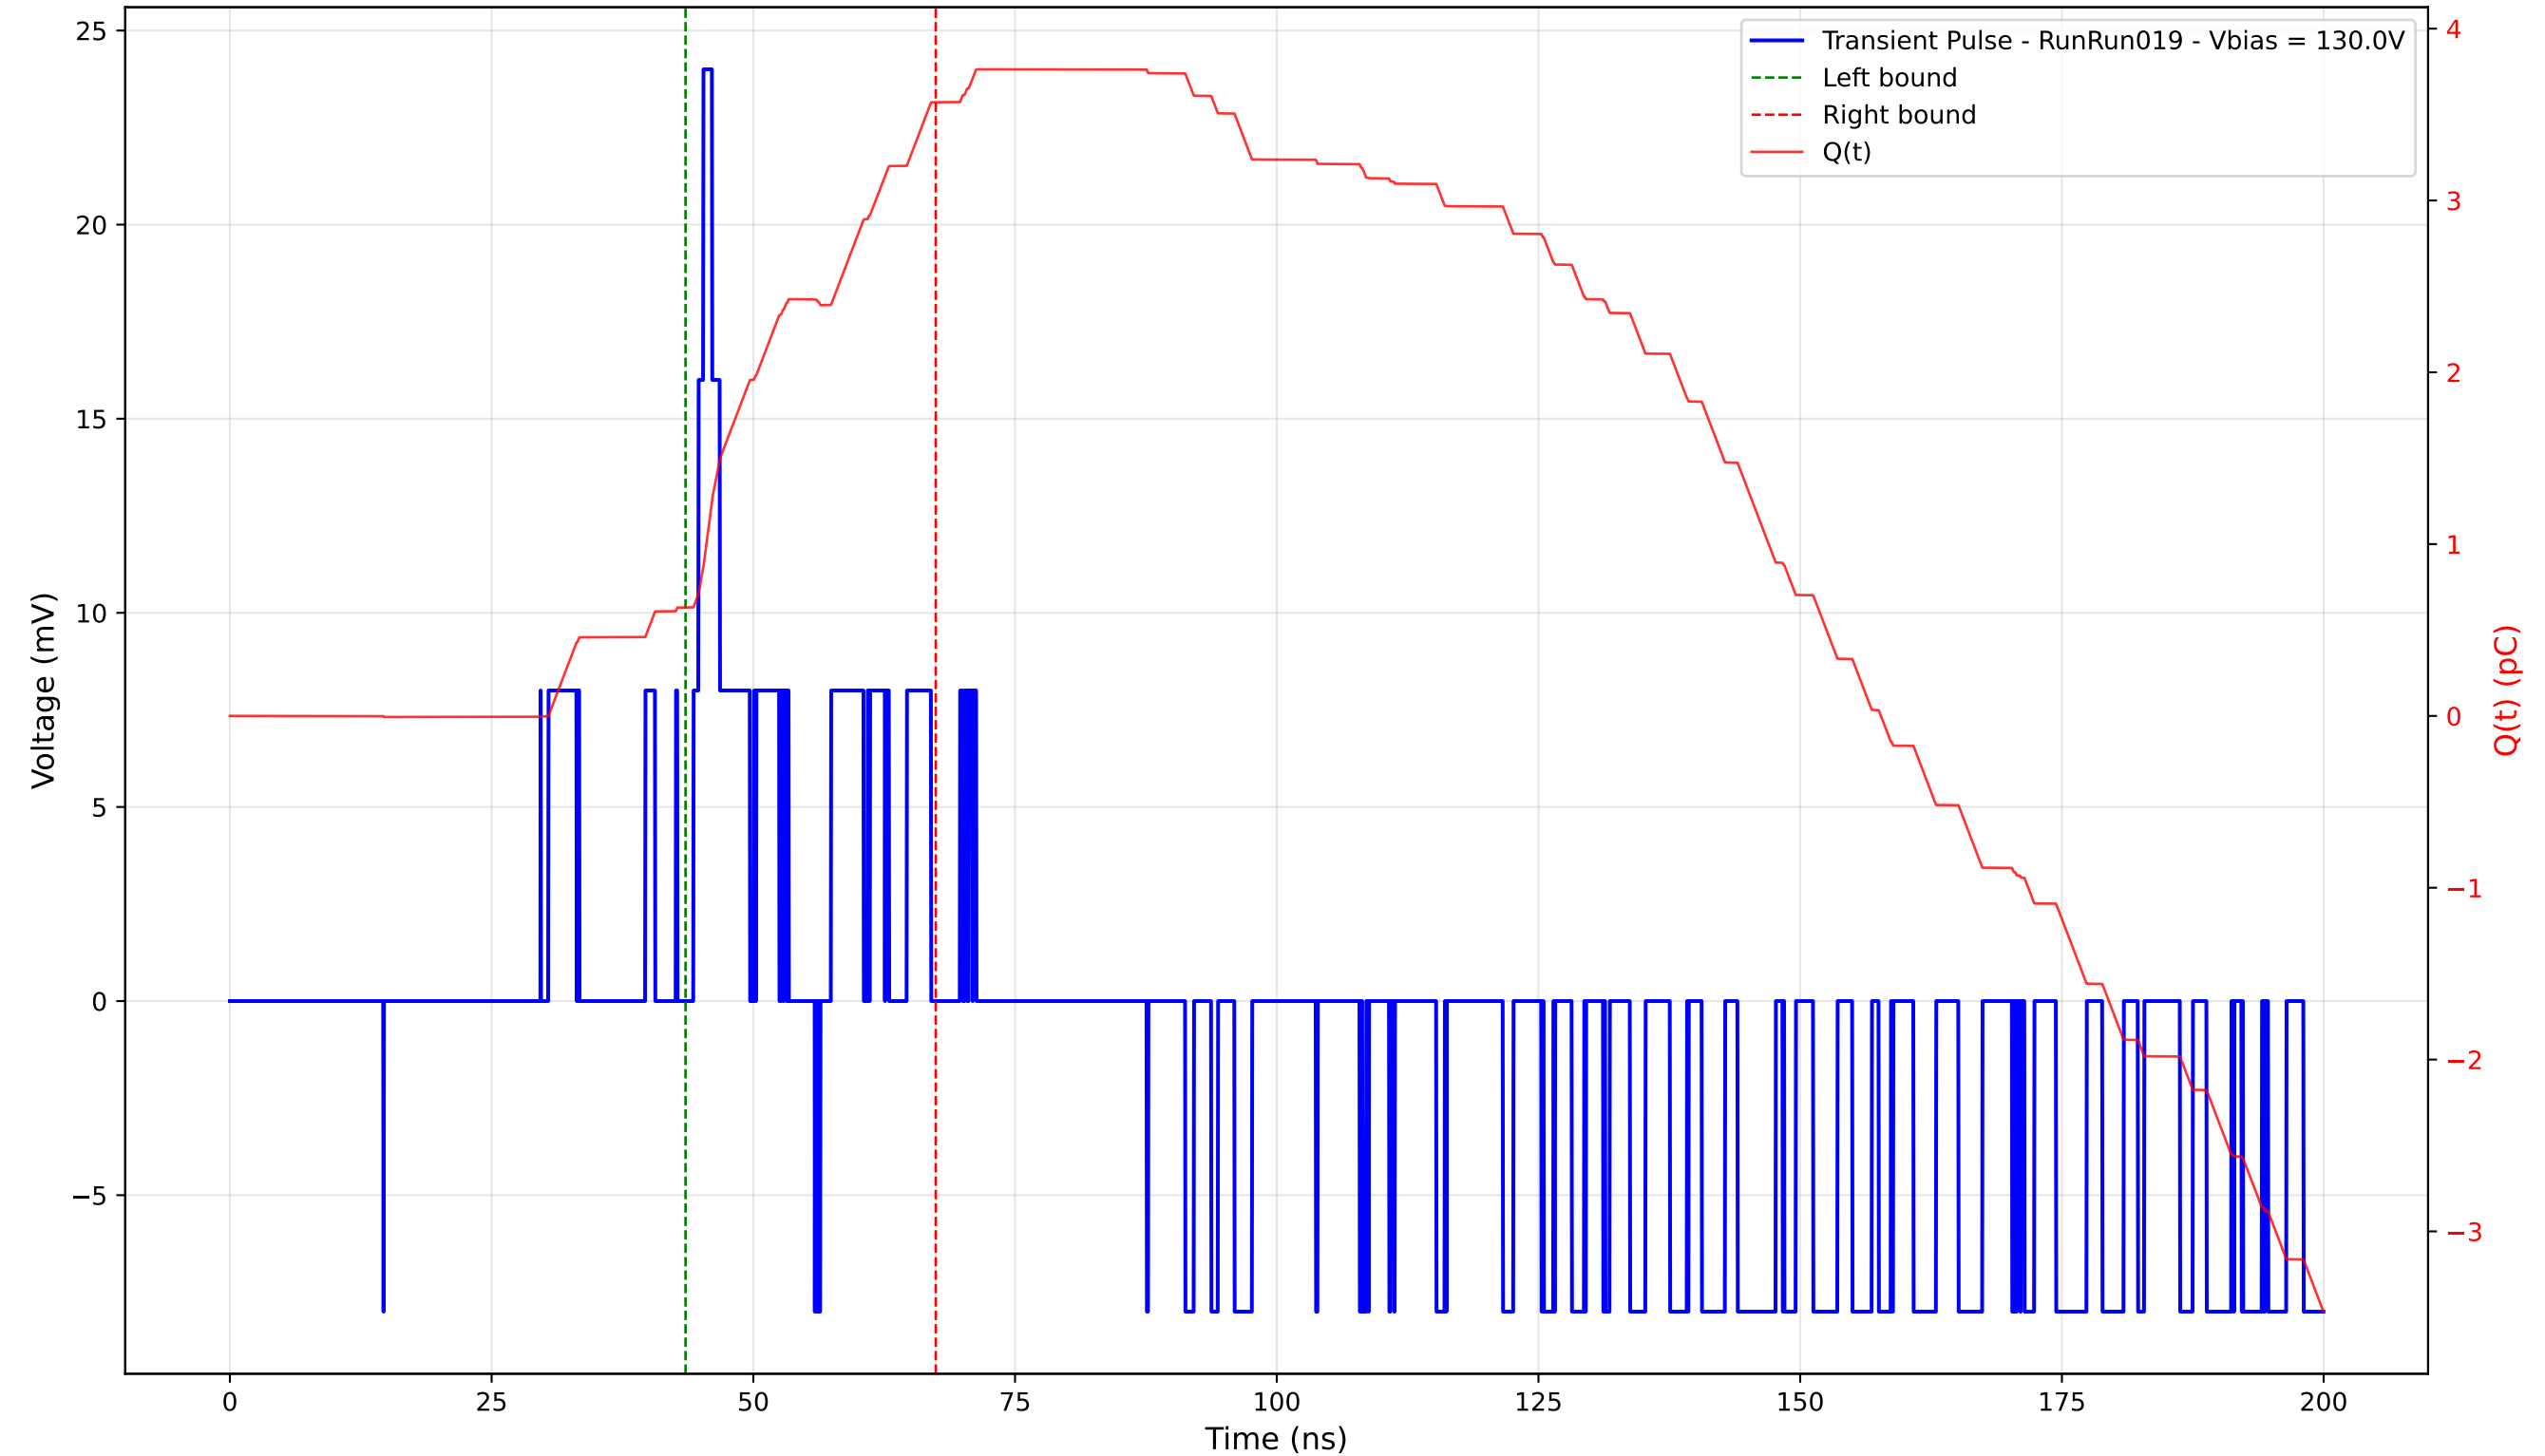


Transient Pulse - Sample: 4003 - Position: 25.0 μm - Charge: 1.40 pC - Rise Time: 0.00 ns (N/A)

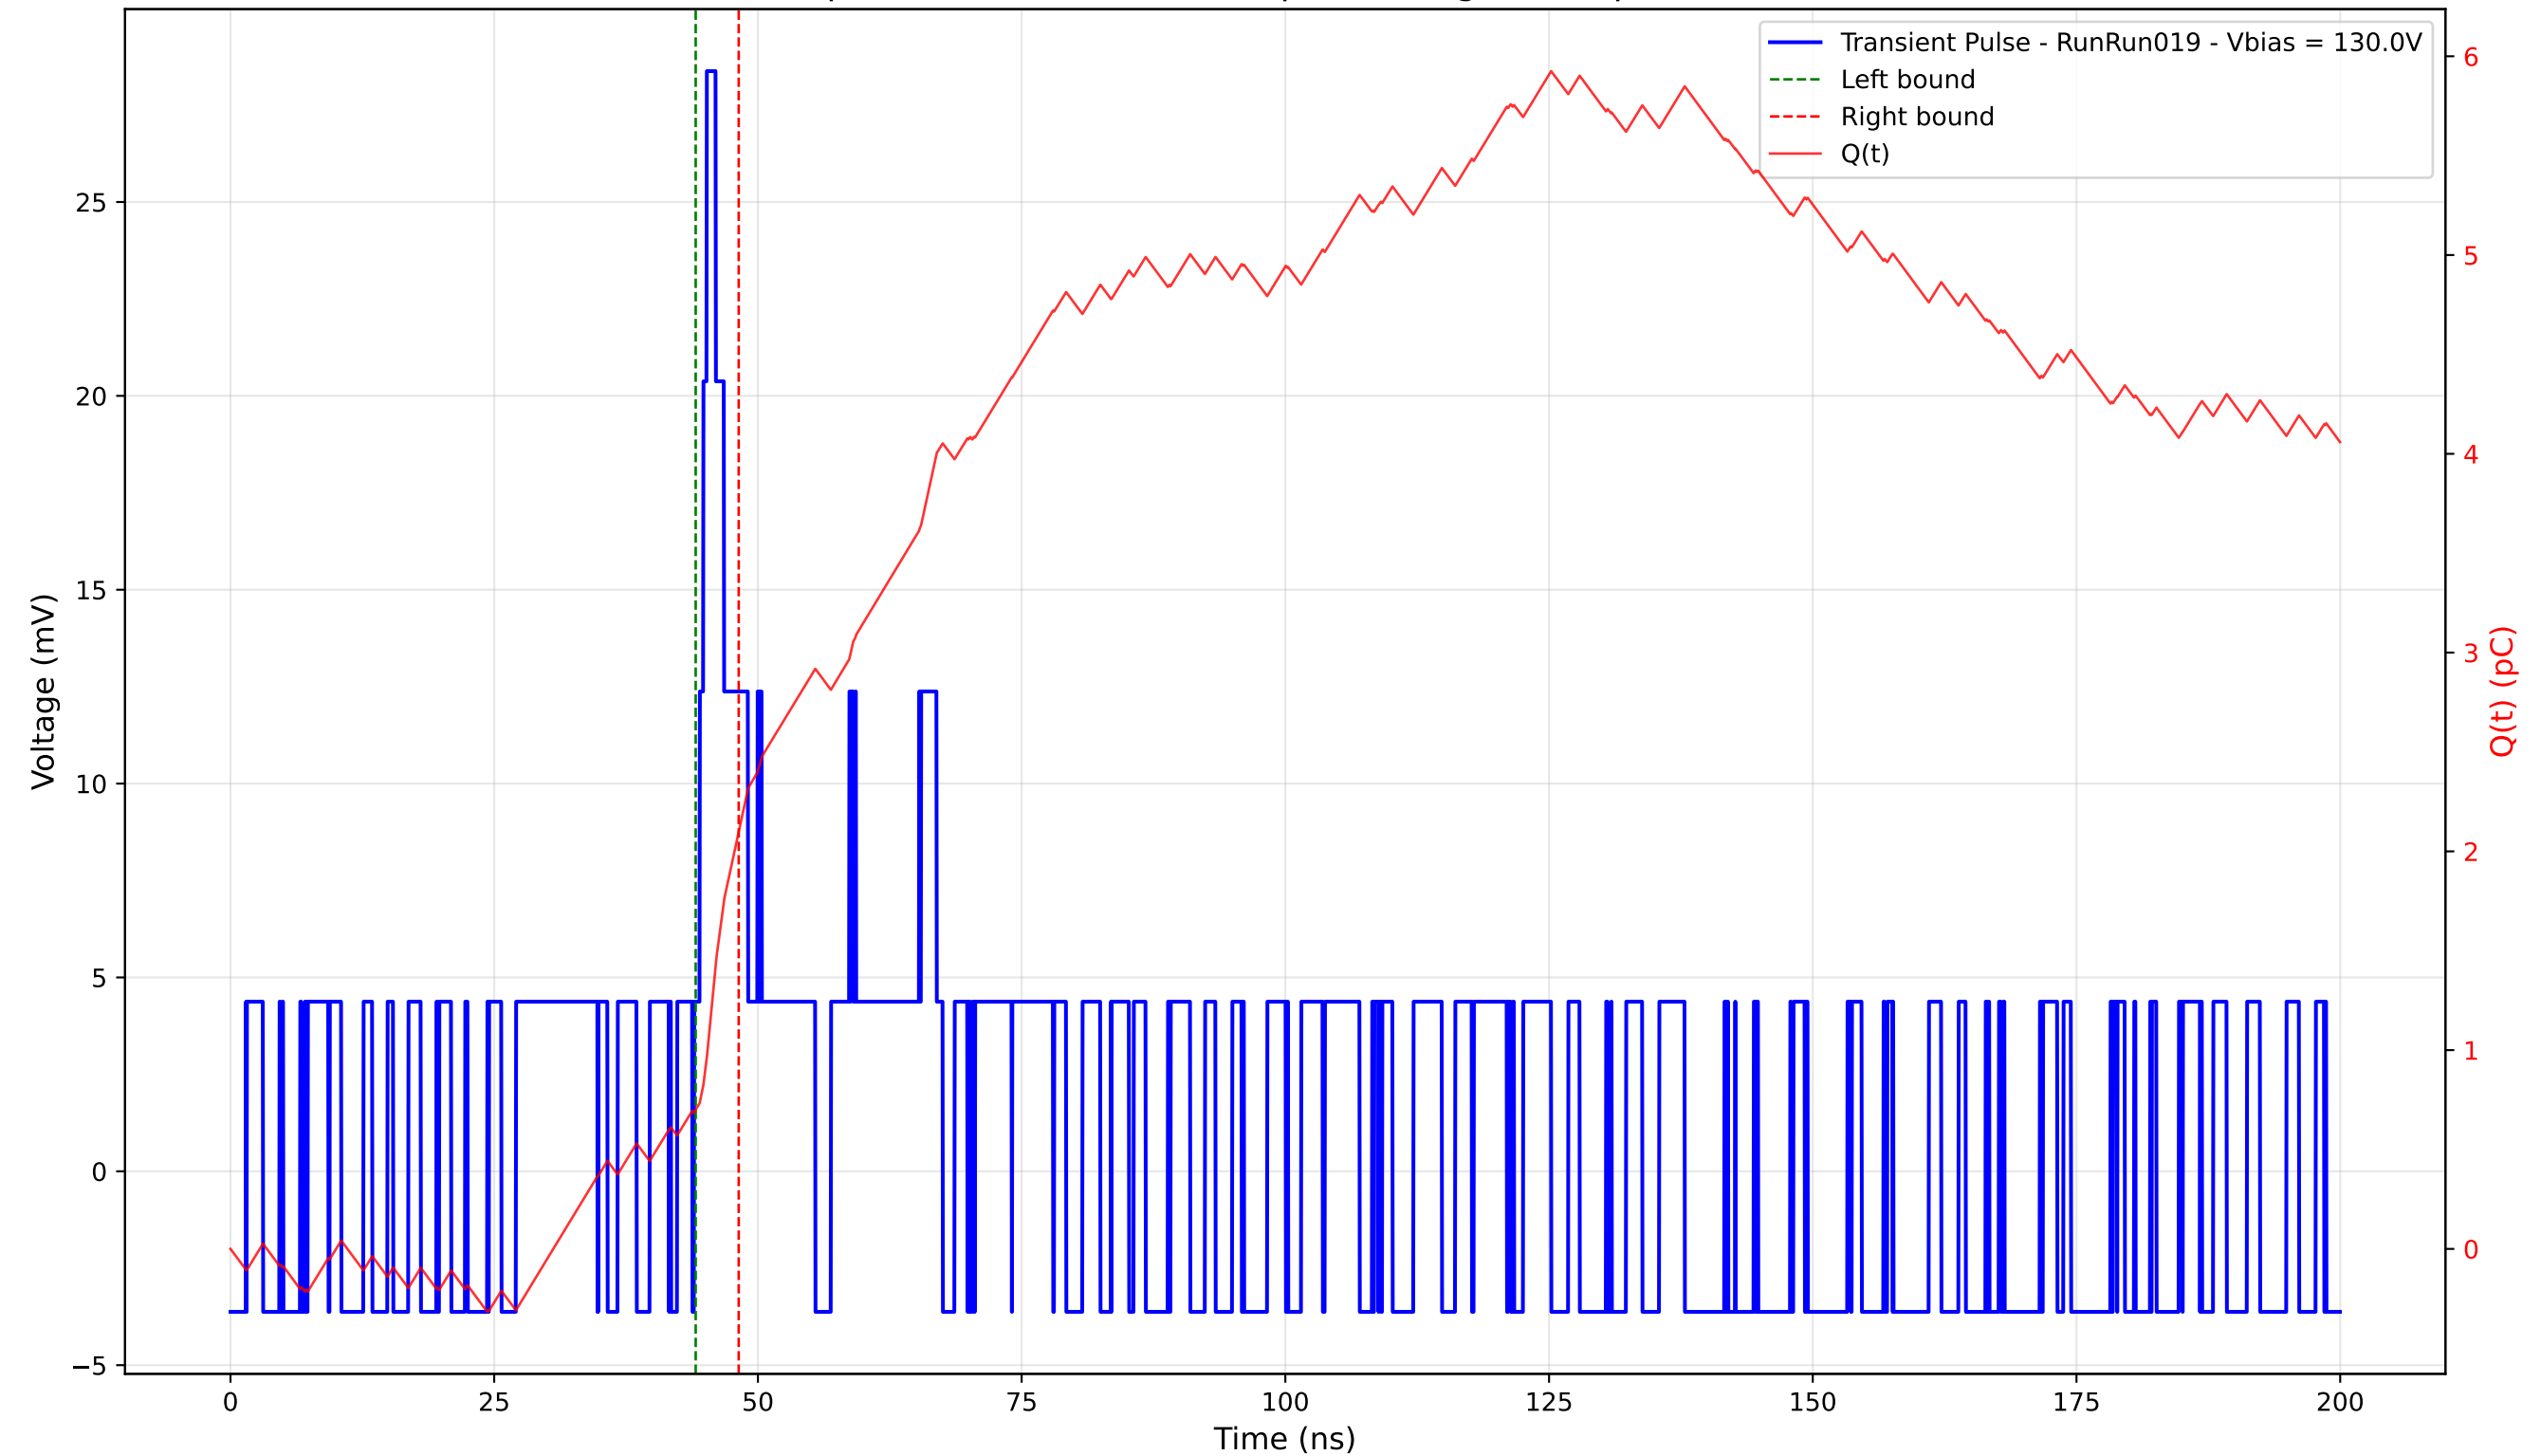


Transient Pulse - Sample: 4003 - Position: 30.0 μm - Charge: 1.09 pC - Rise Time: 0.92 ns

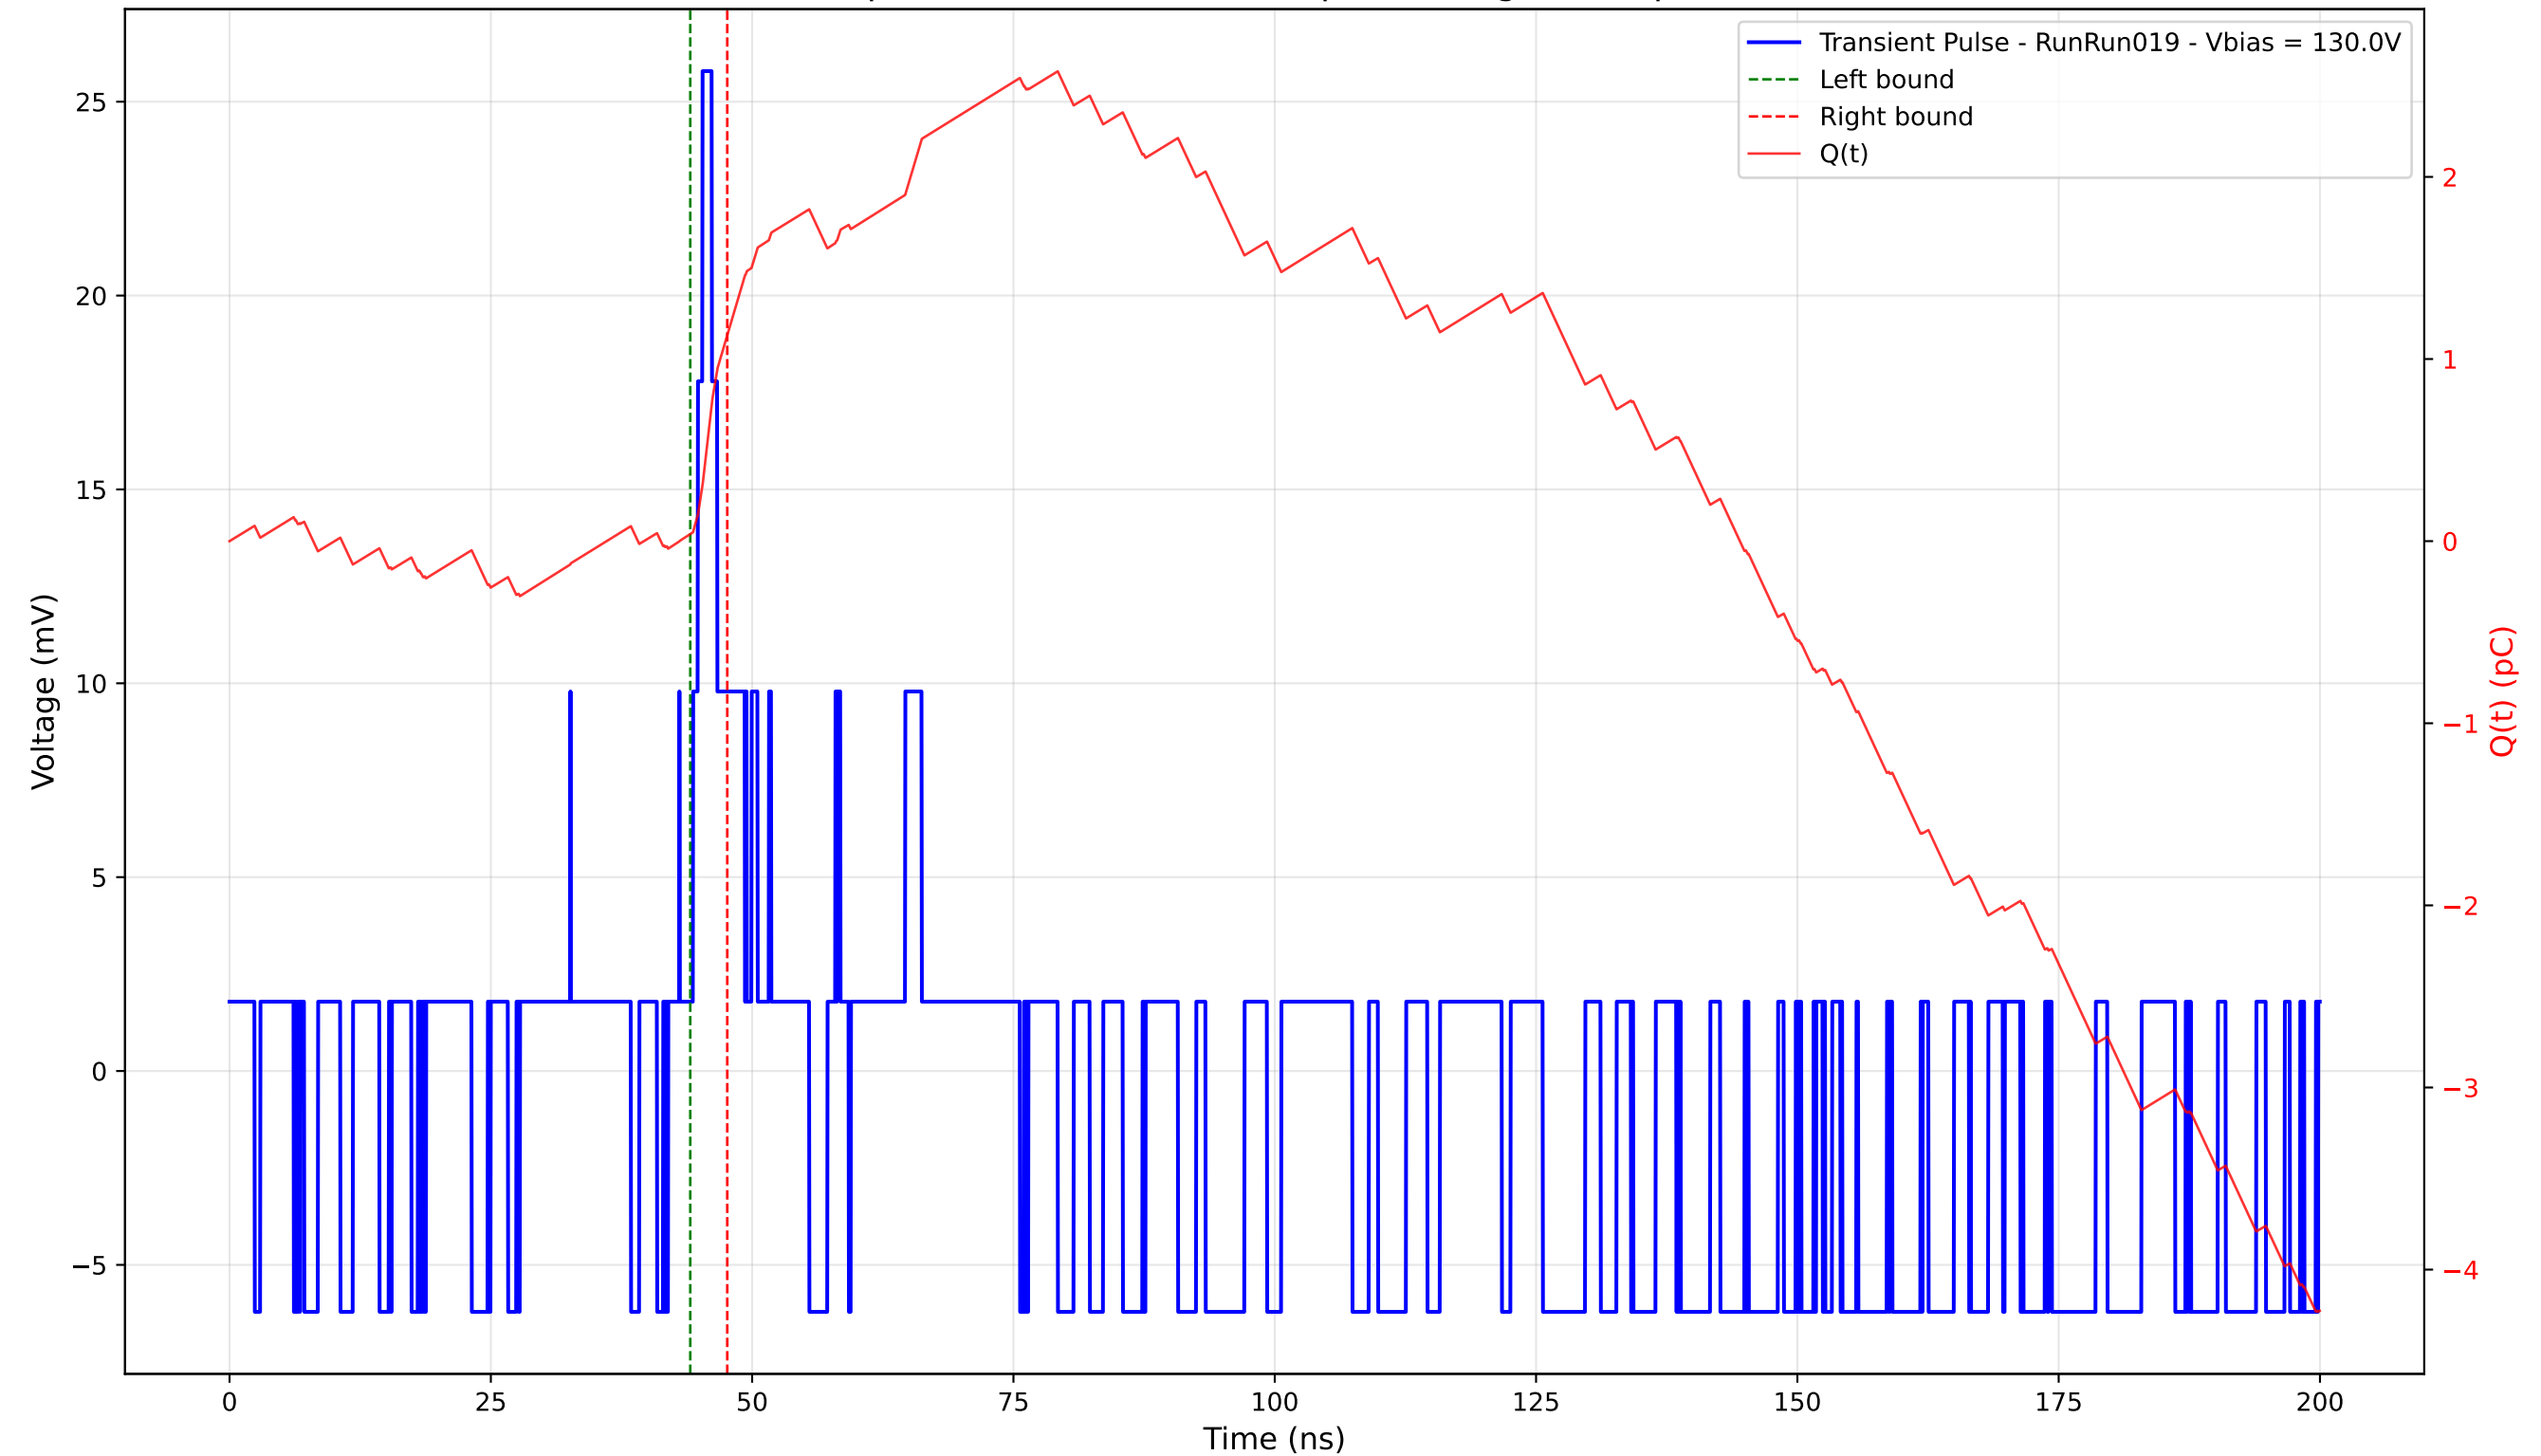


Transient Pulse - Sample: 4003 - Position: 35.0 μm - Charge: 1.13 pC - Rise Time: 0.76 ns

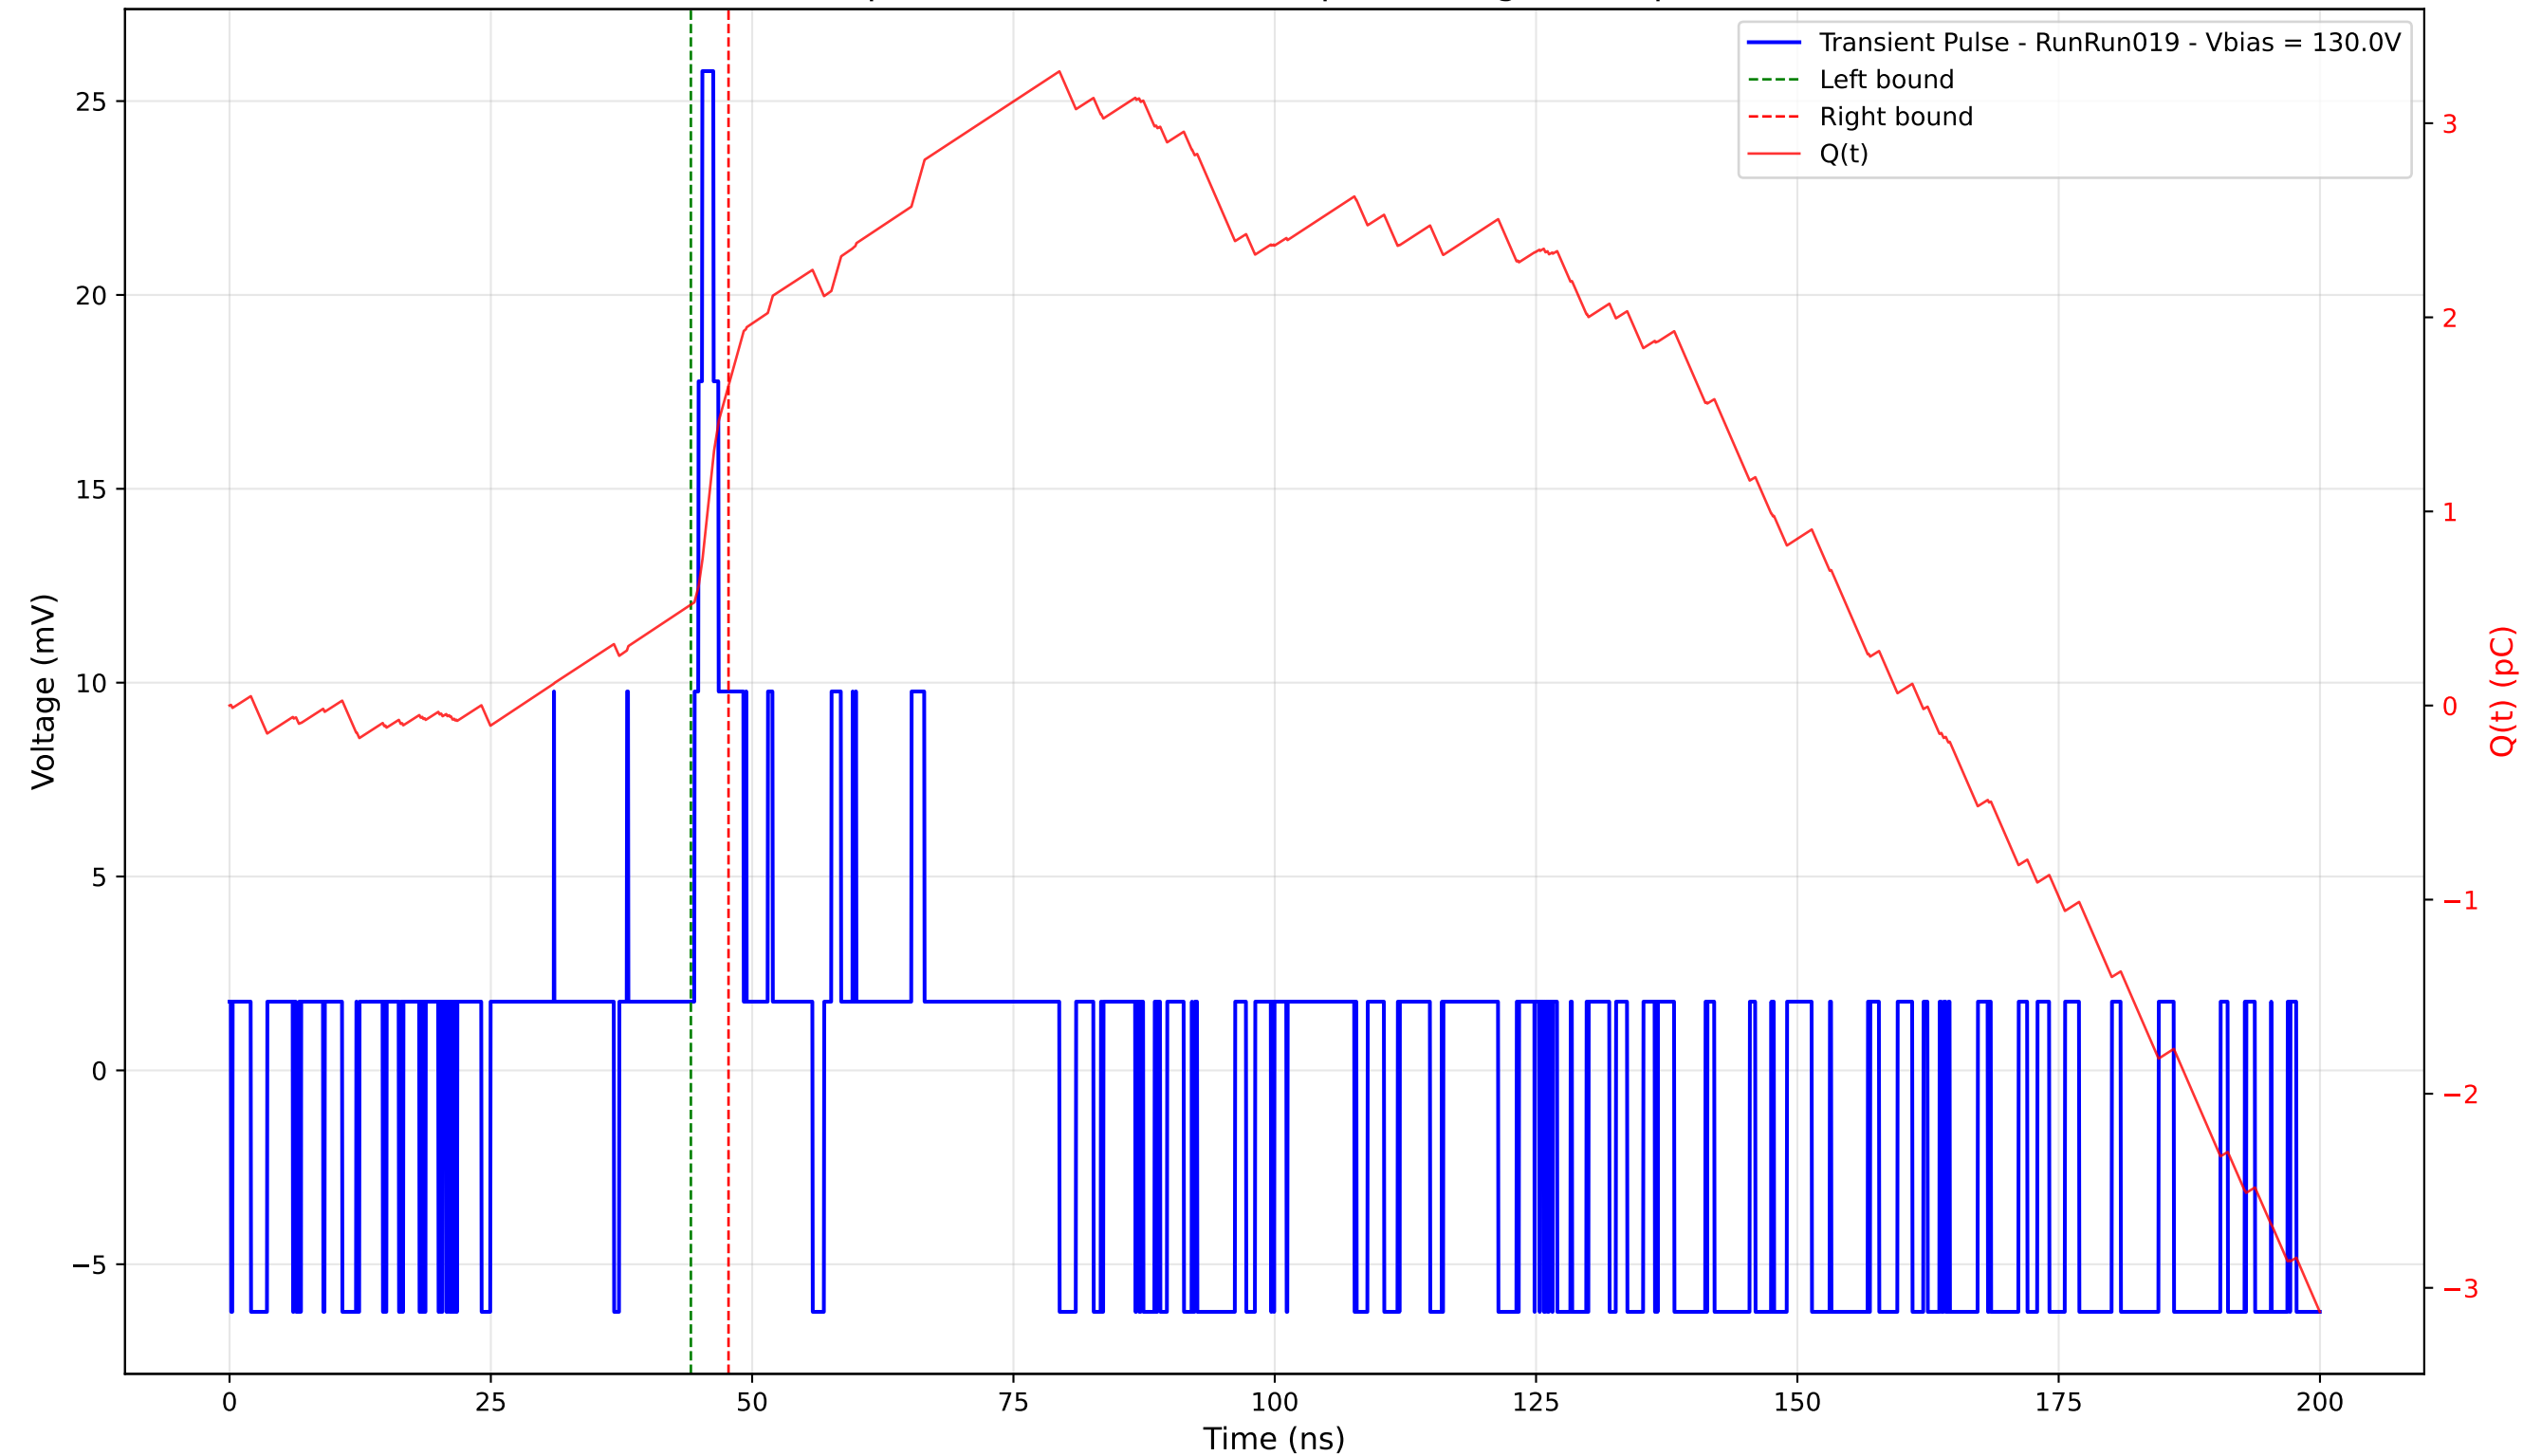


Transient Pulse - Sample: 4003 - Position: 40.0 μm - Charge: 1.89 pC - Rise Time: 0.00 ns (N/A)

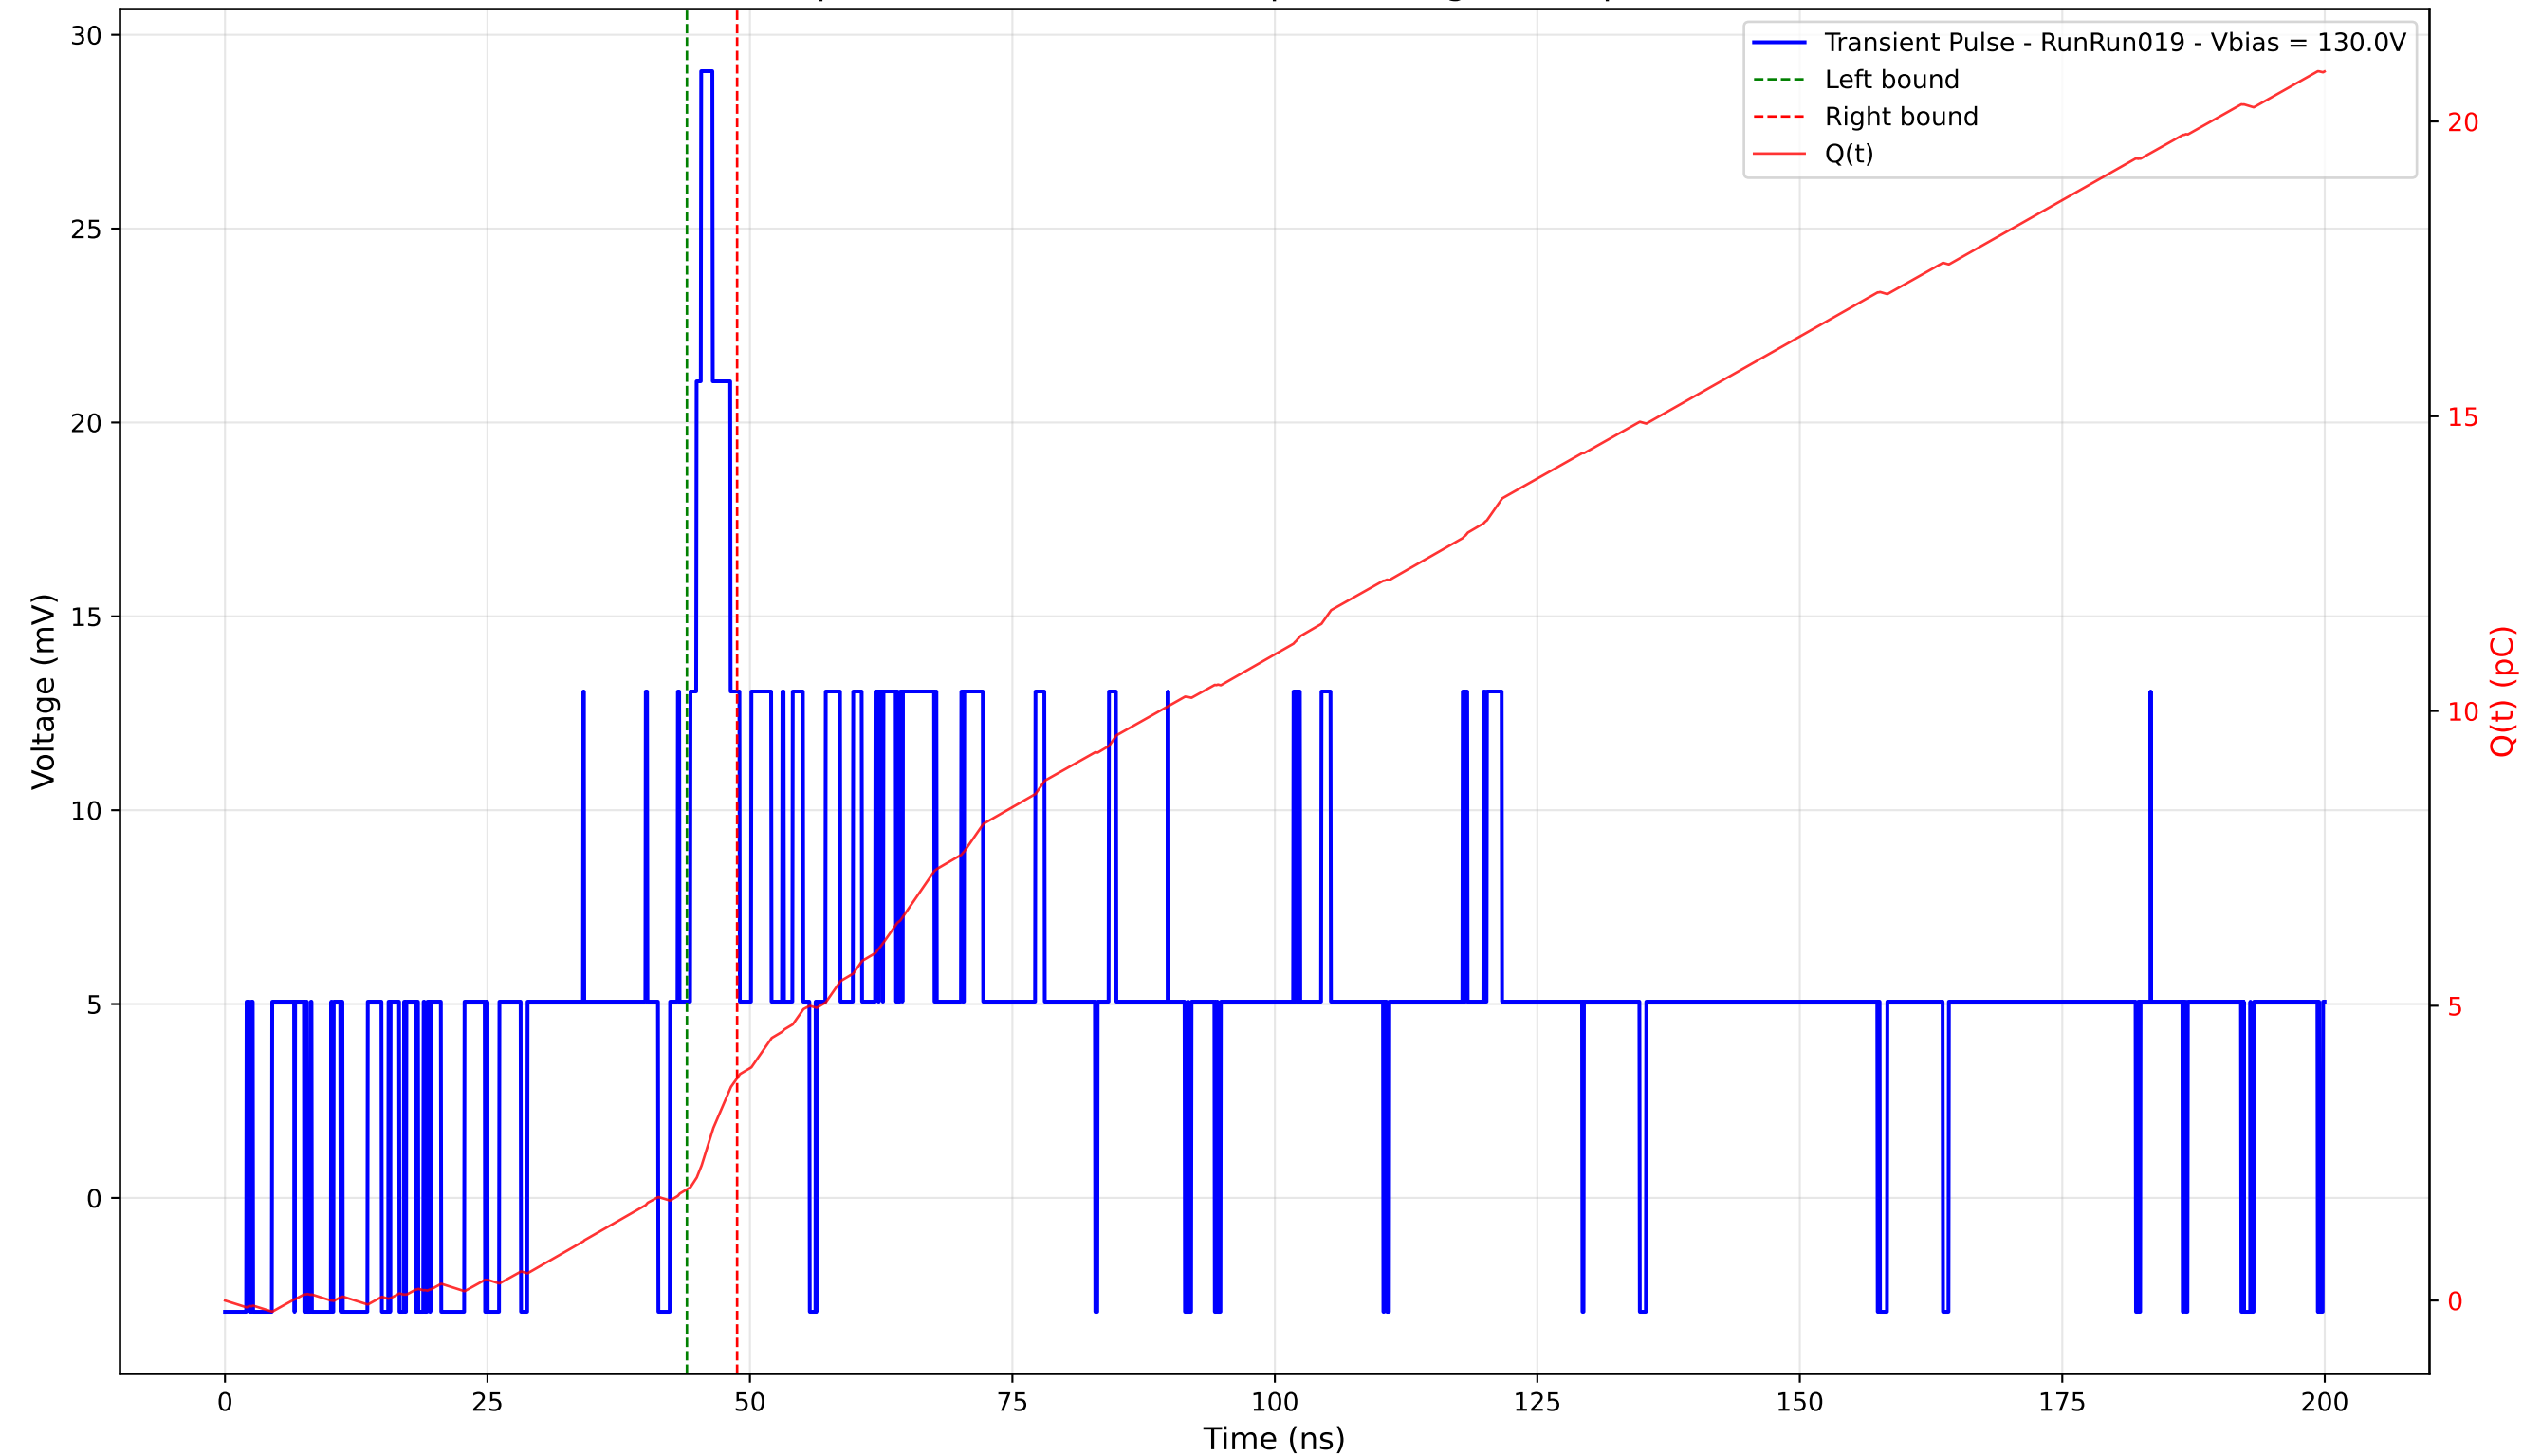


Transient Pulse - Sample: 4003 - Position: 45.0 μm - Charge: 2.86 pC - Rise Time: 2.43 ns

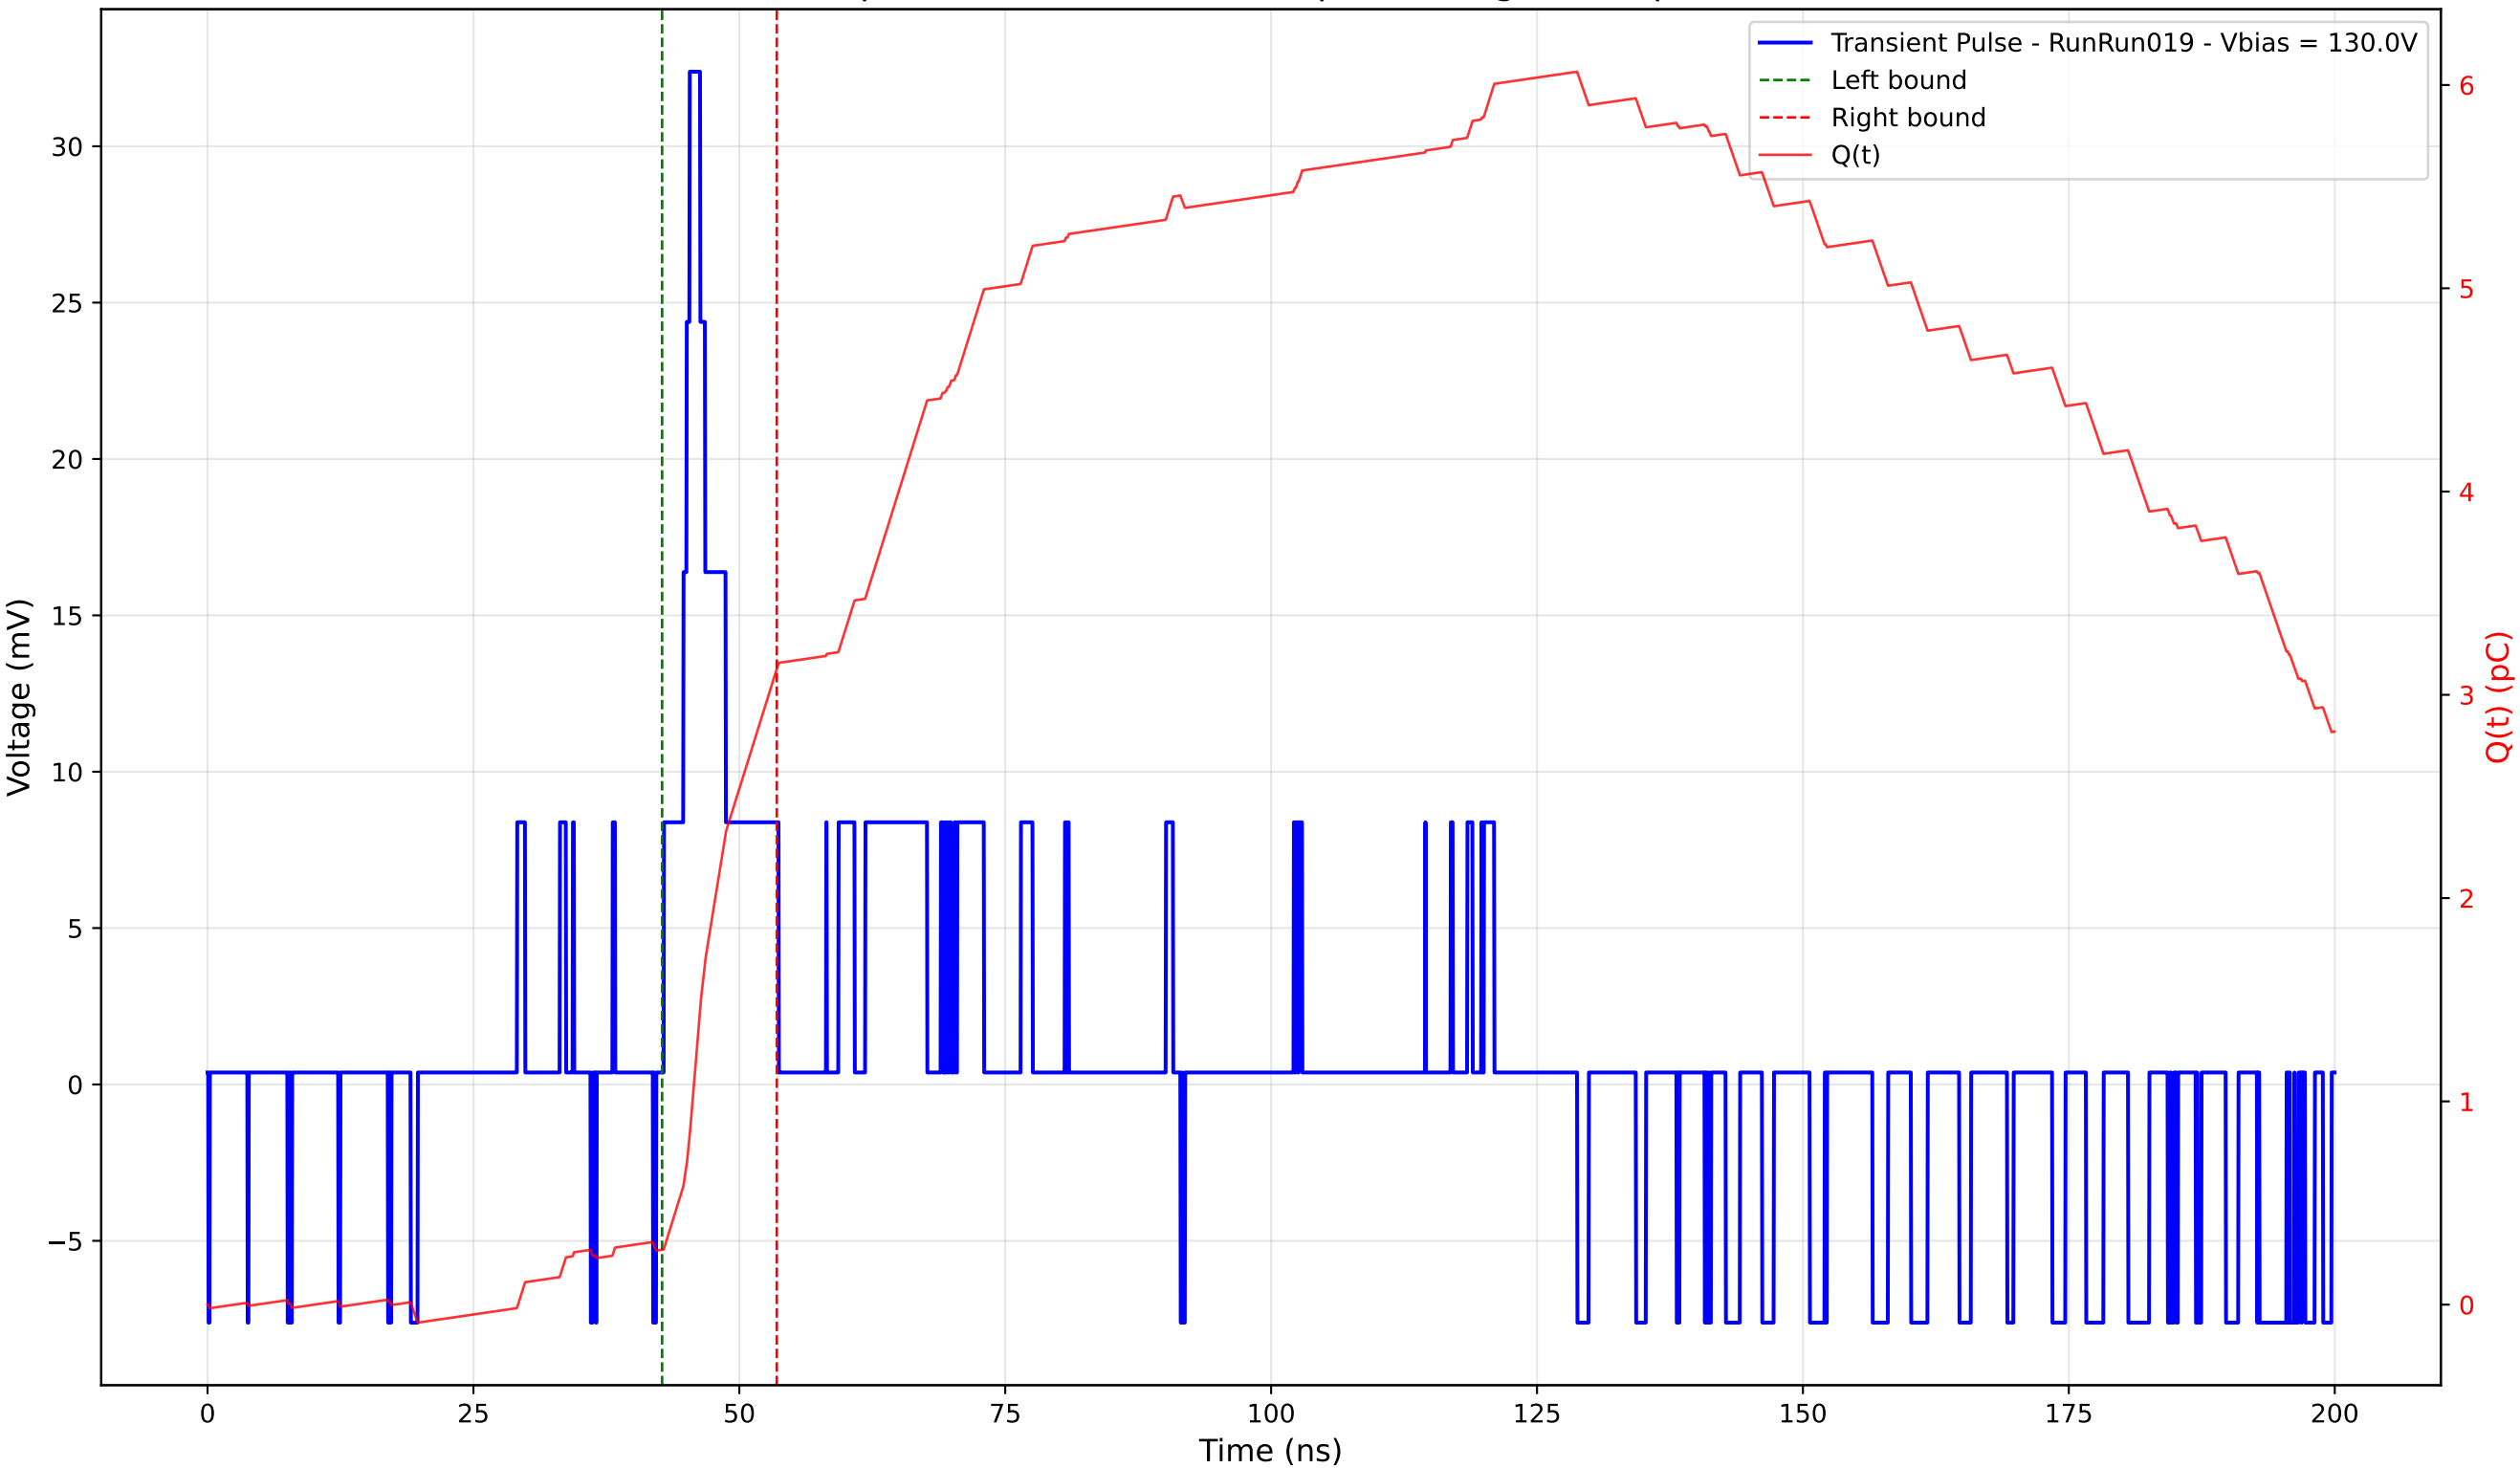


Transient Pulse - Sample: 4003 - Position: 50.0 μm - Charge: 2.99 pC - Rise Time: 1.25 ns

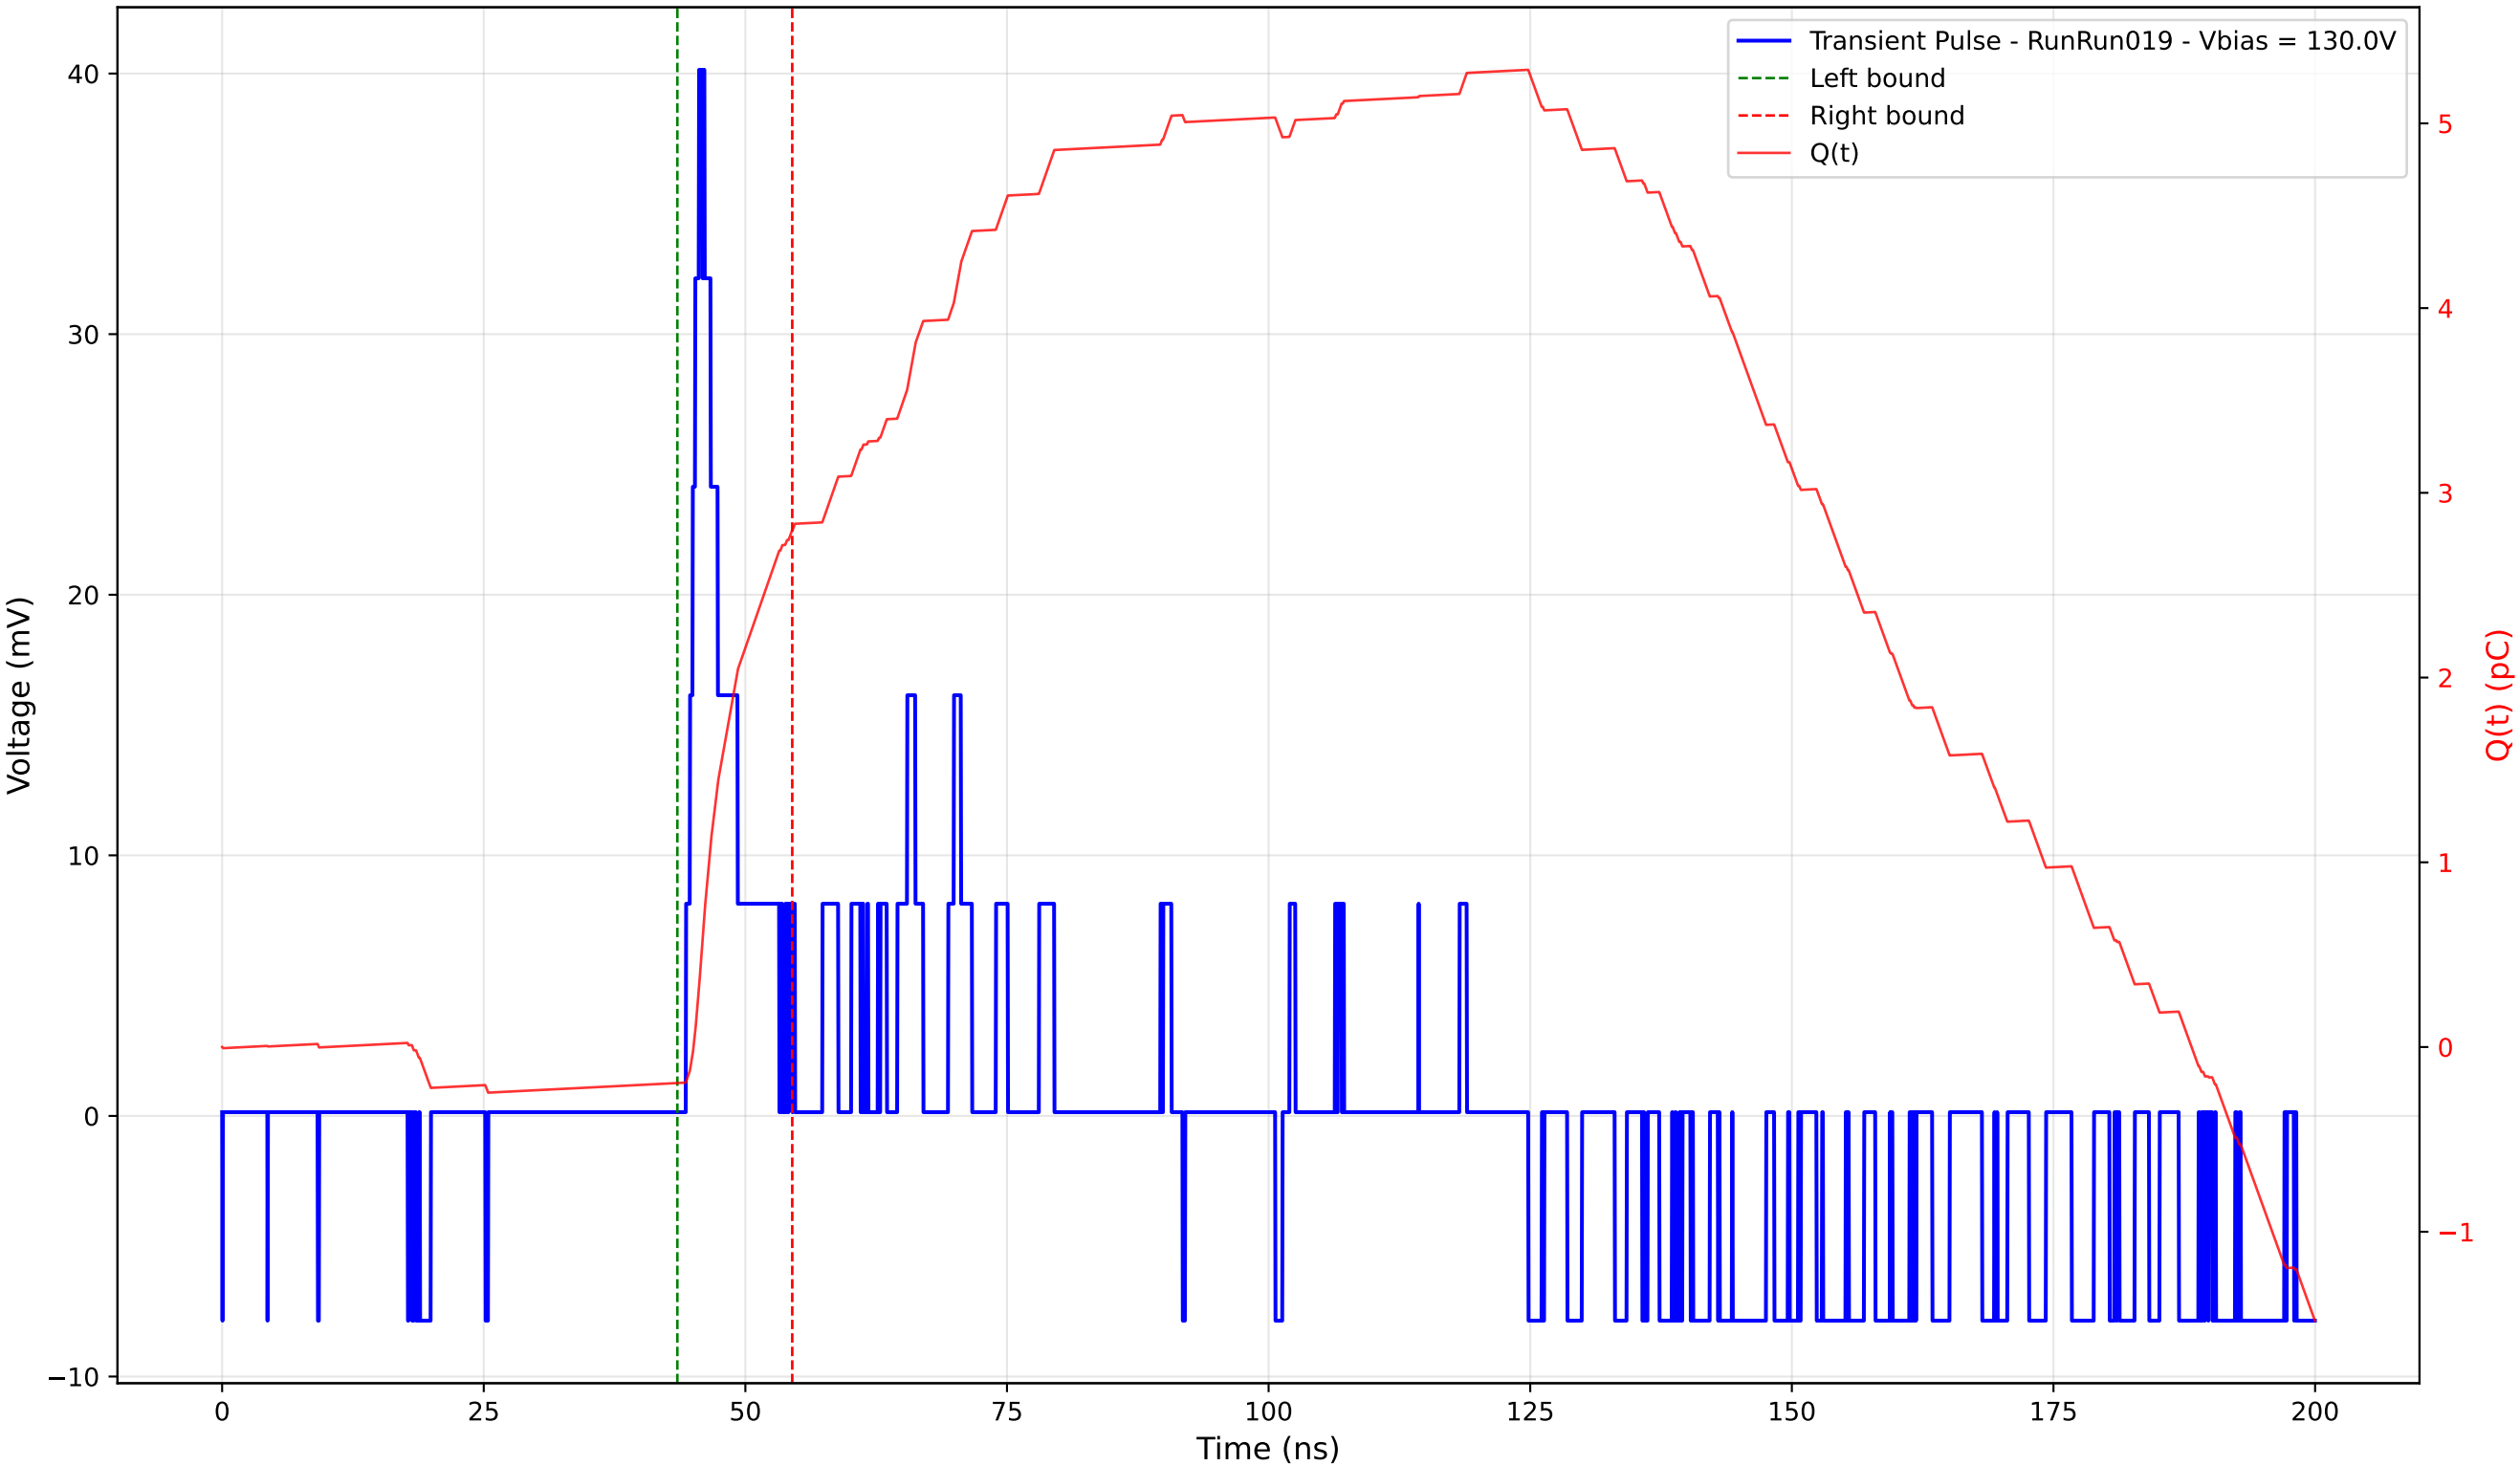


Transient Pulse - Sample: 4003 - Position: 55.0 μm - Charge: 4.53 pC - Rise Time: 4.01 ns

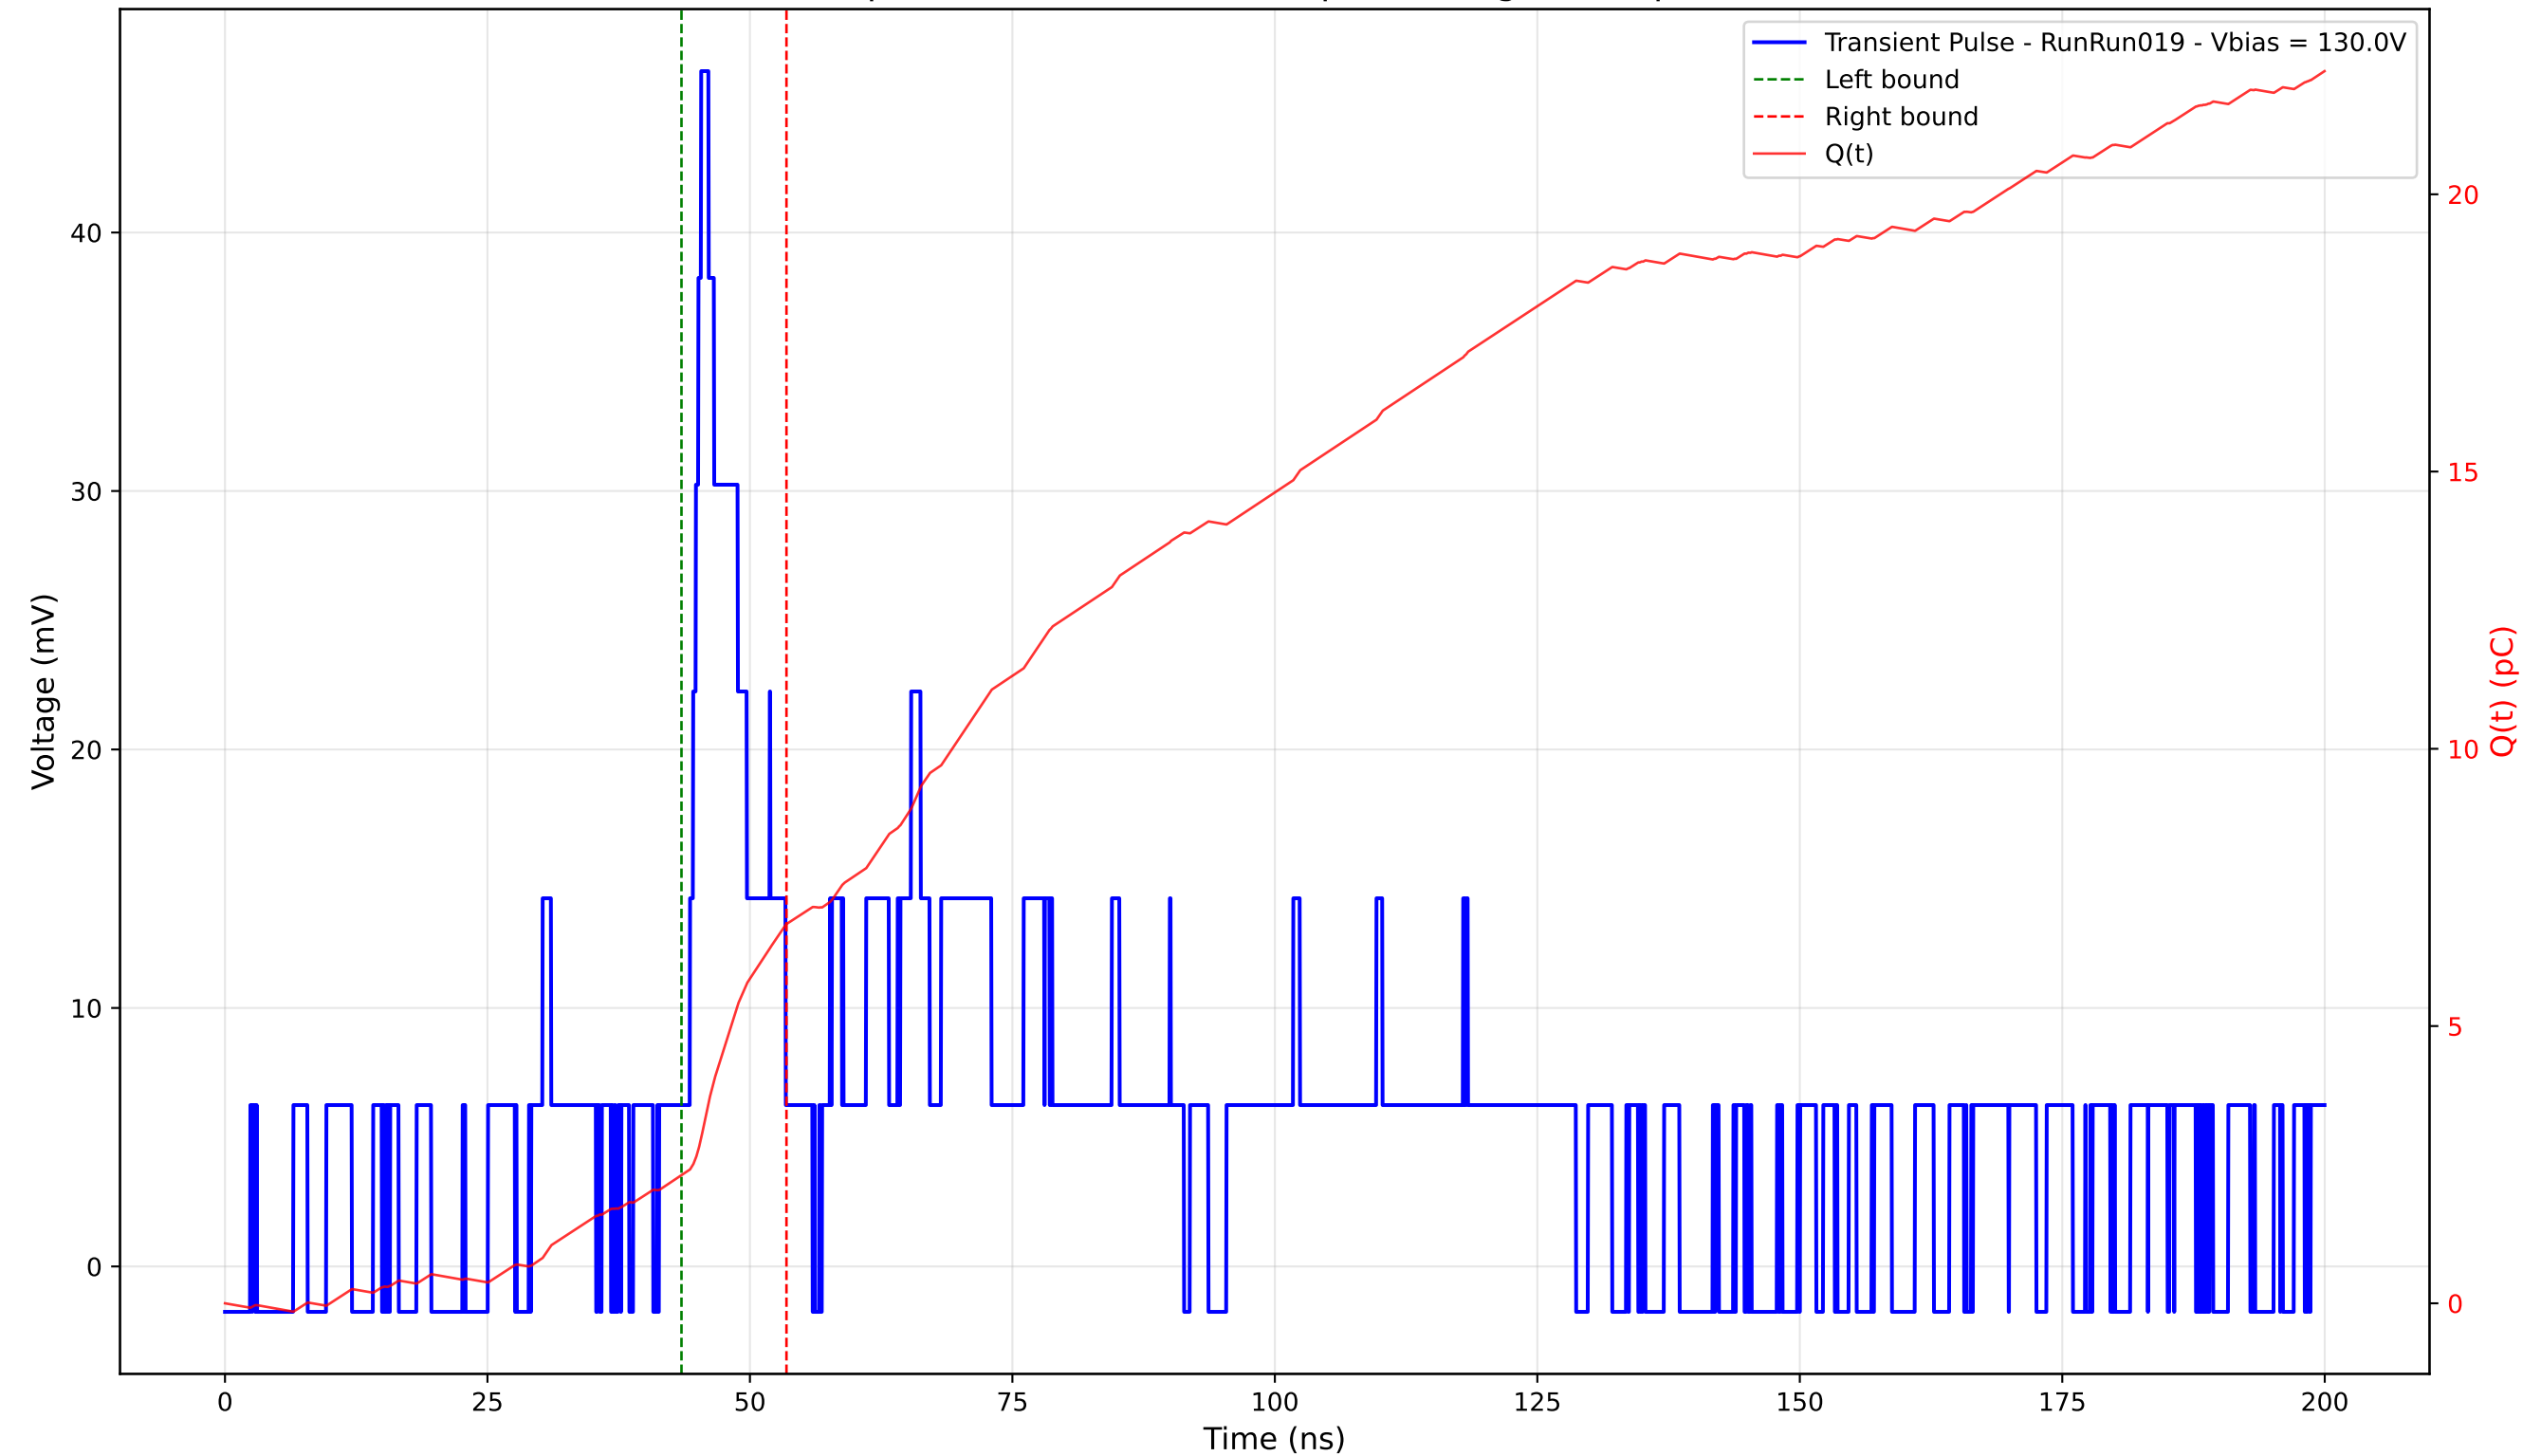


Transient Pulse - Sample: 4003 - Position: 60.0 μm - Charge: 3.22 pC - Rise Time: 0.93 ns

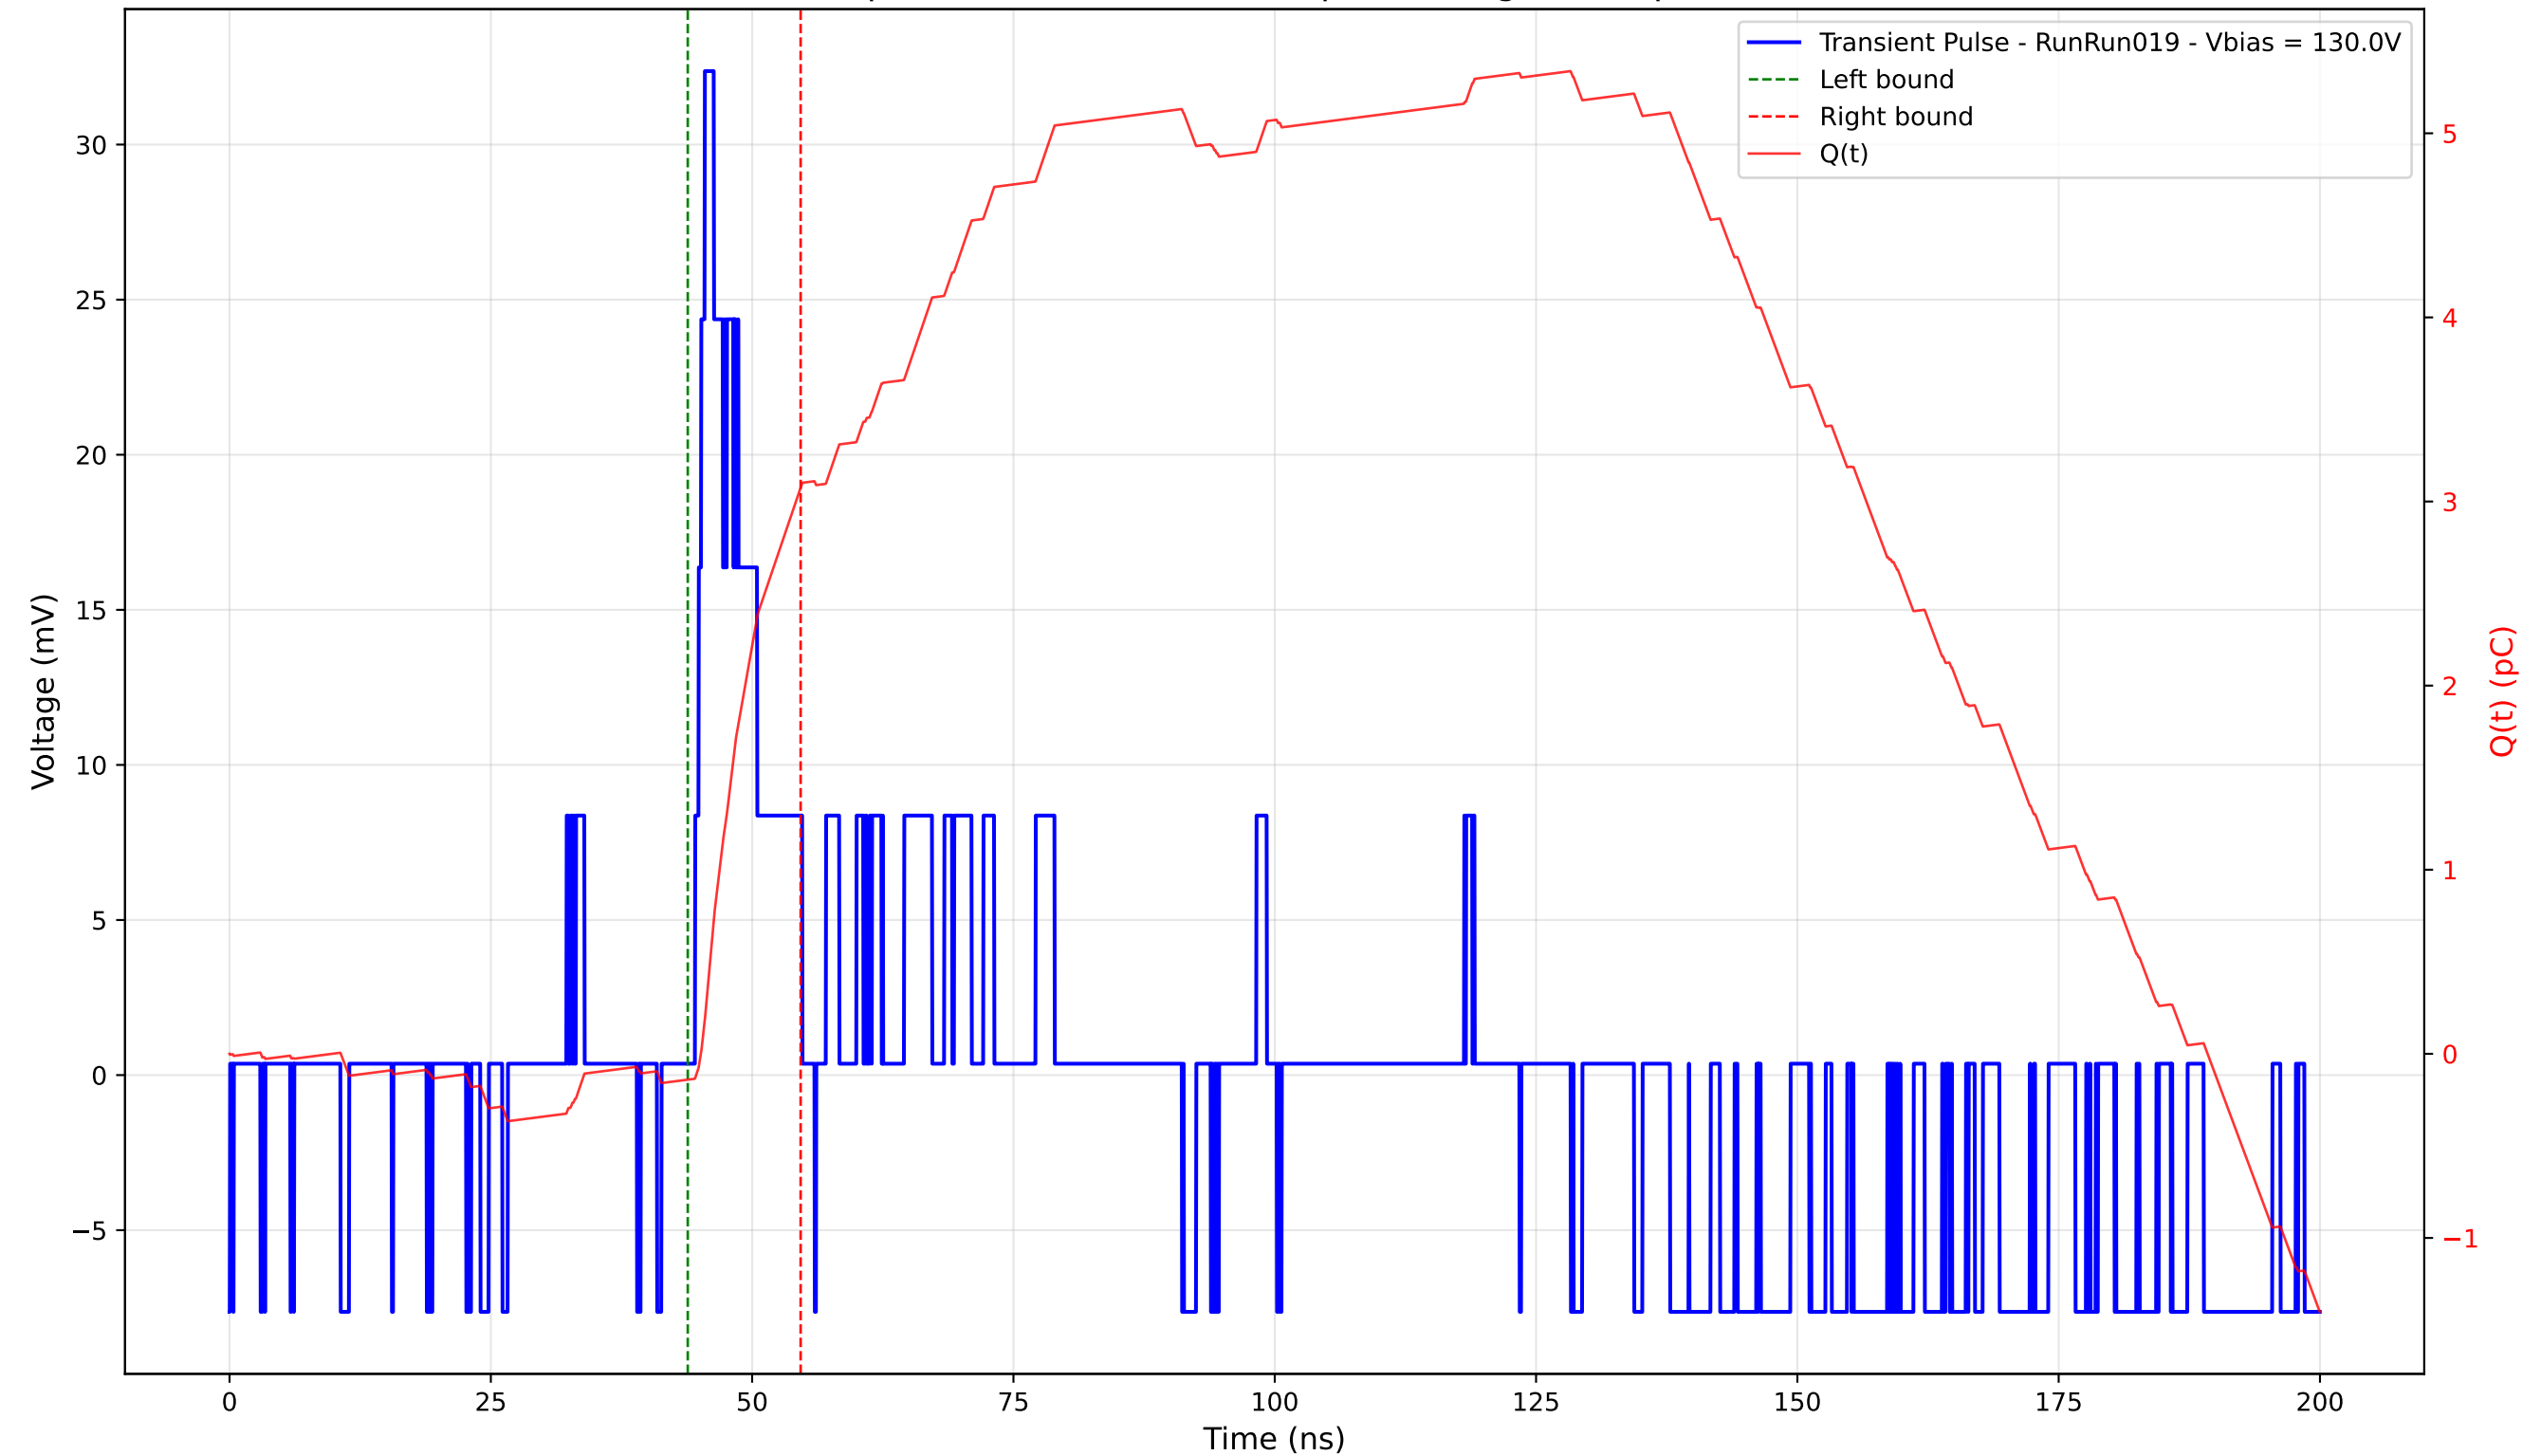


Transient Pulse - Sample: 4003 - Position: 65.0 μm - Charge: 3.50 pC - Rise Time: 2.32 ns

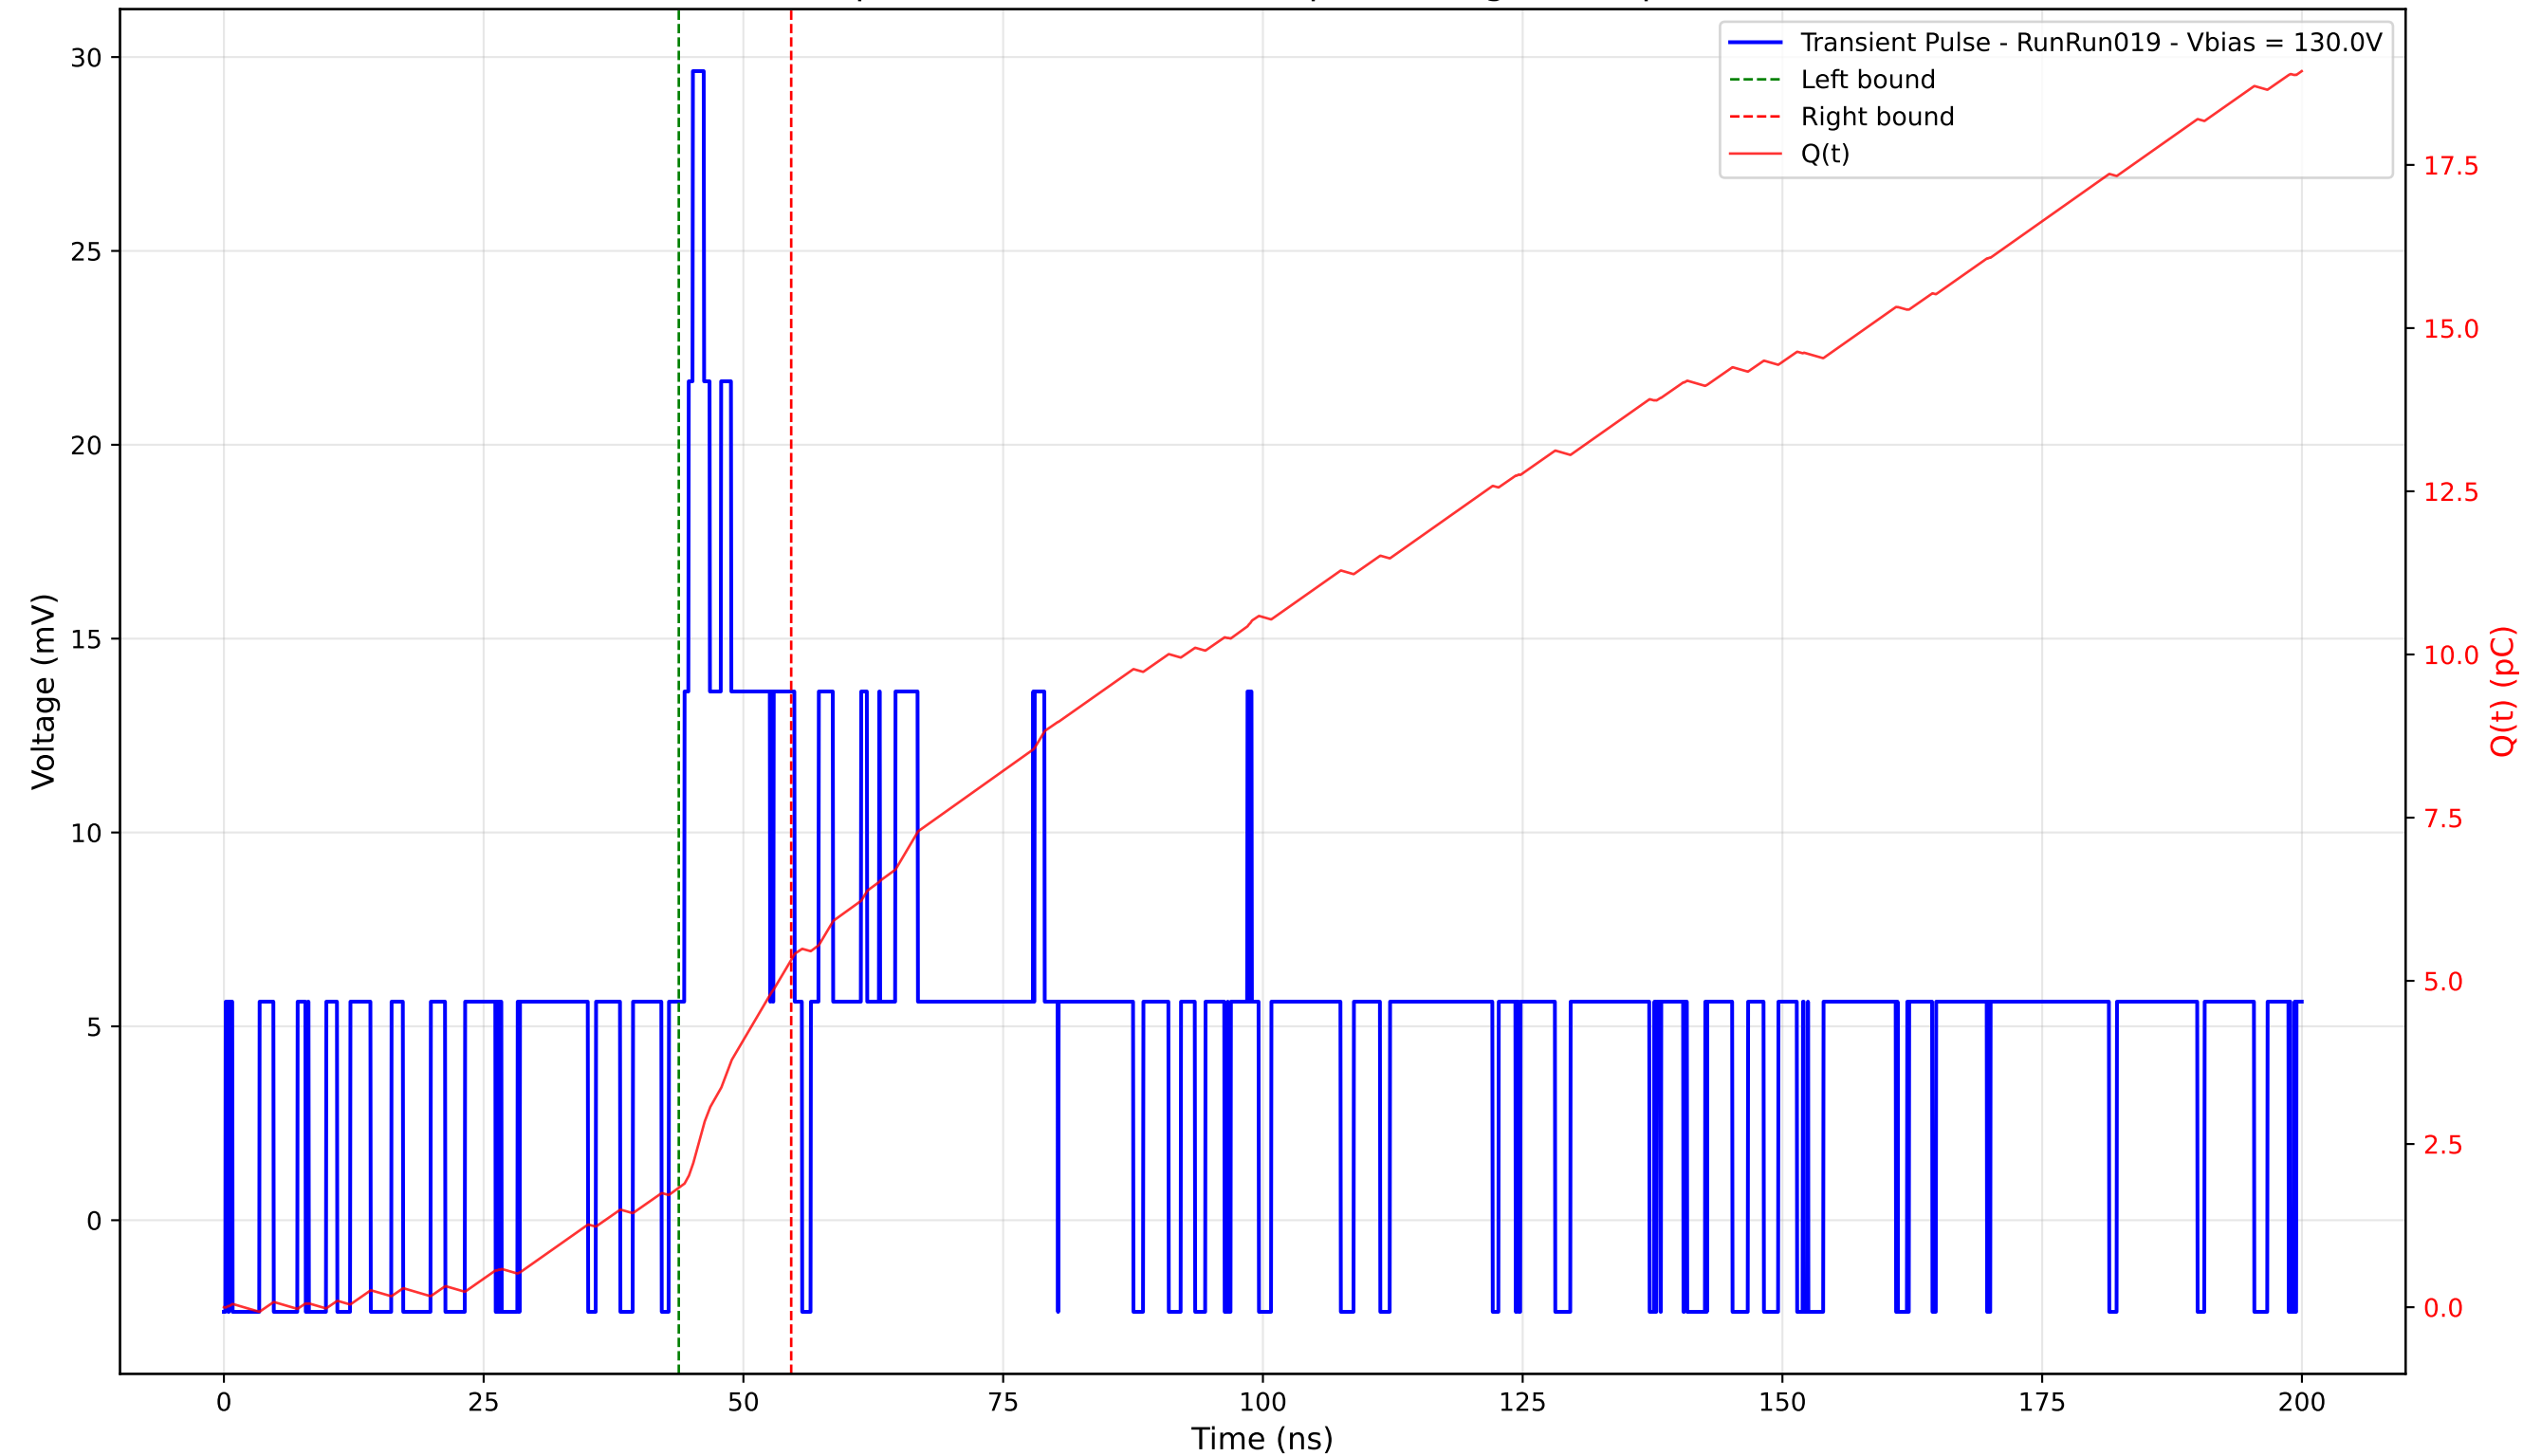


Transient Pulse - Sample: 4003 - Position: 70.0 μm - Charge: 2.96 pC - Rise Time: 0.74 ns

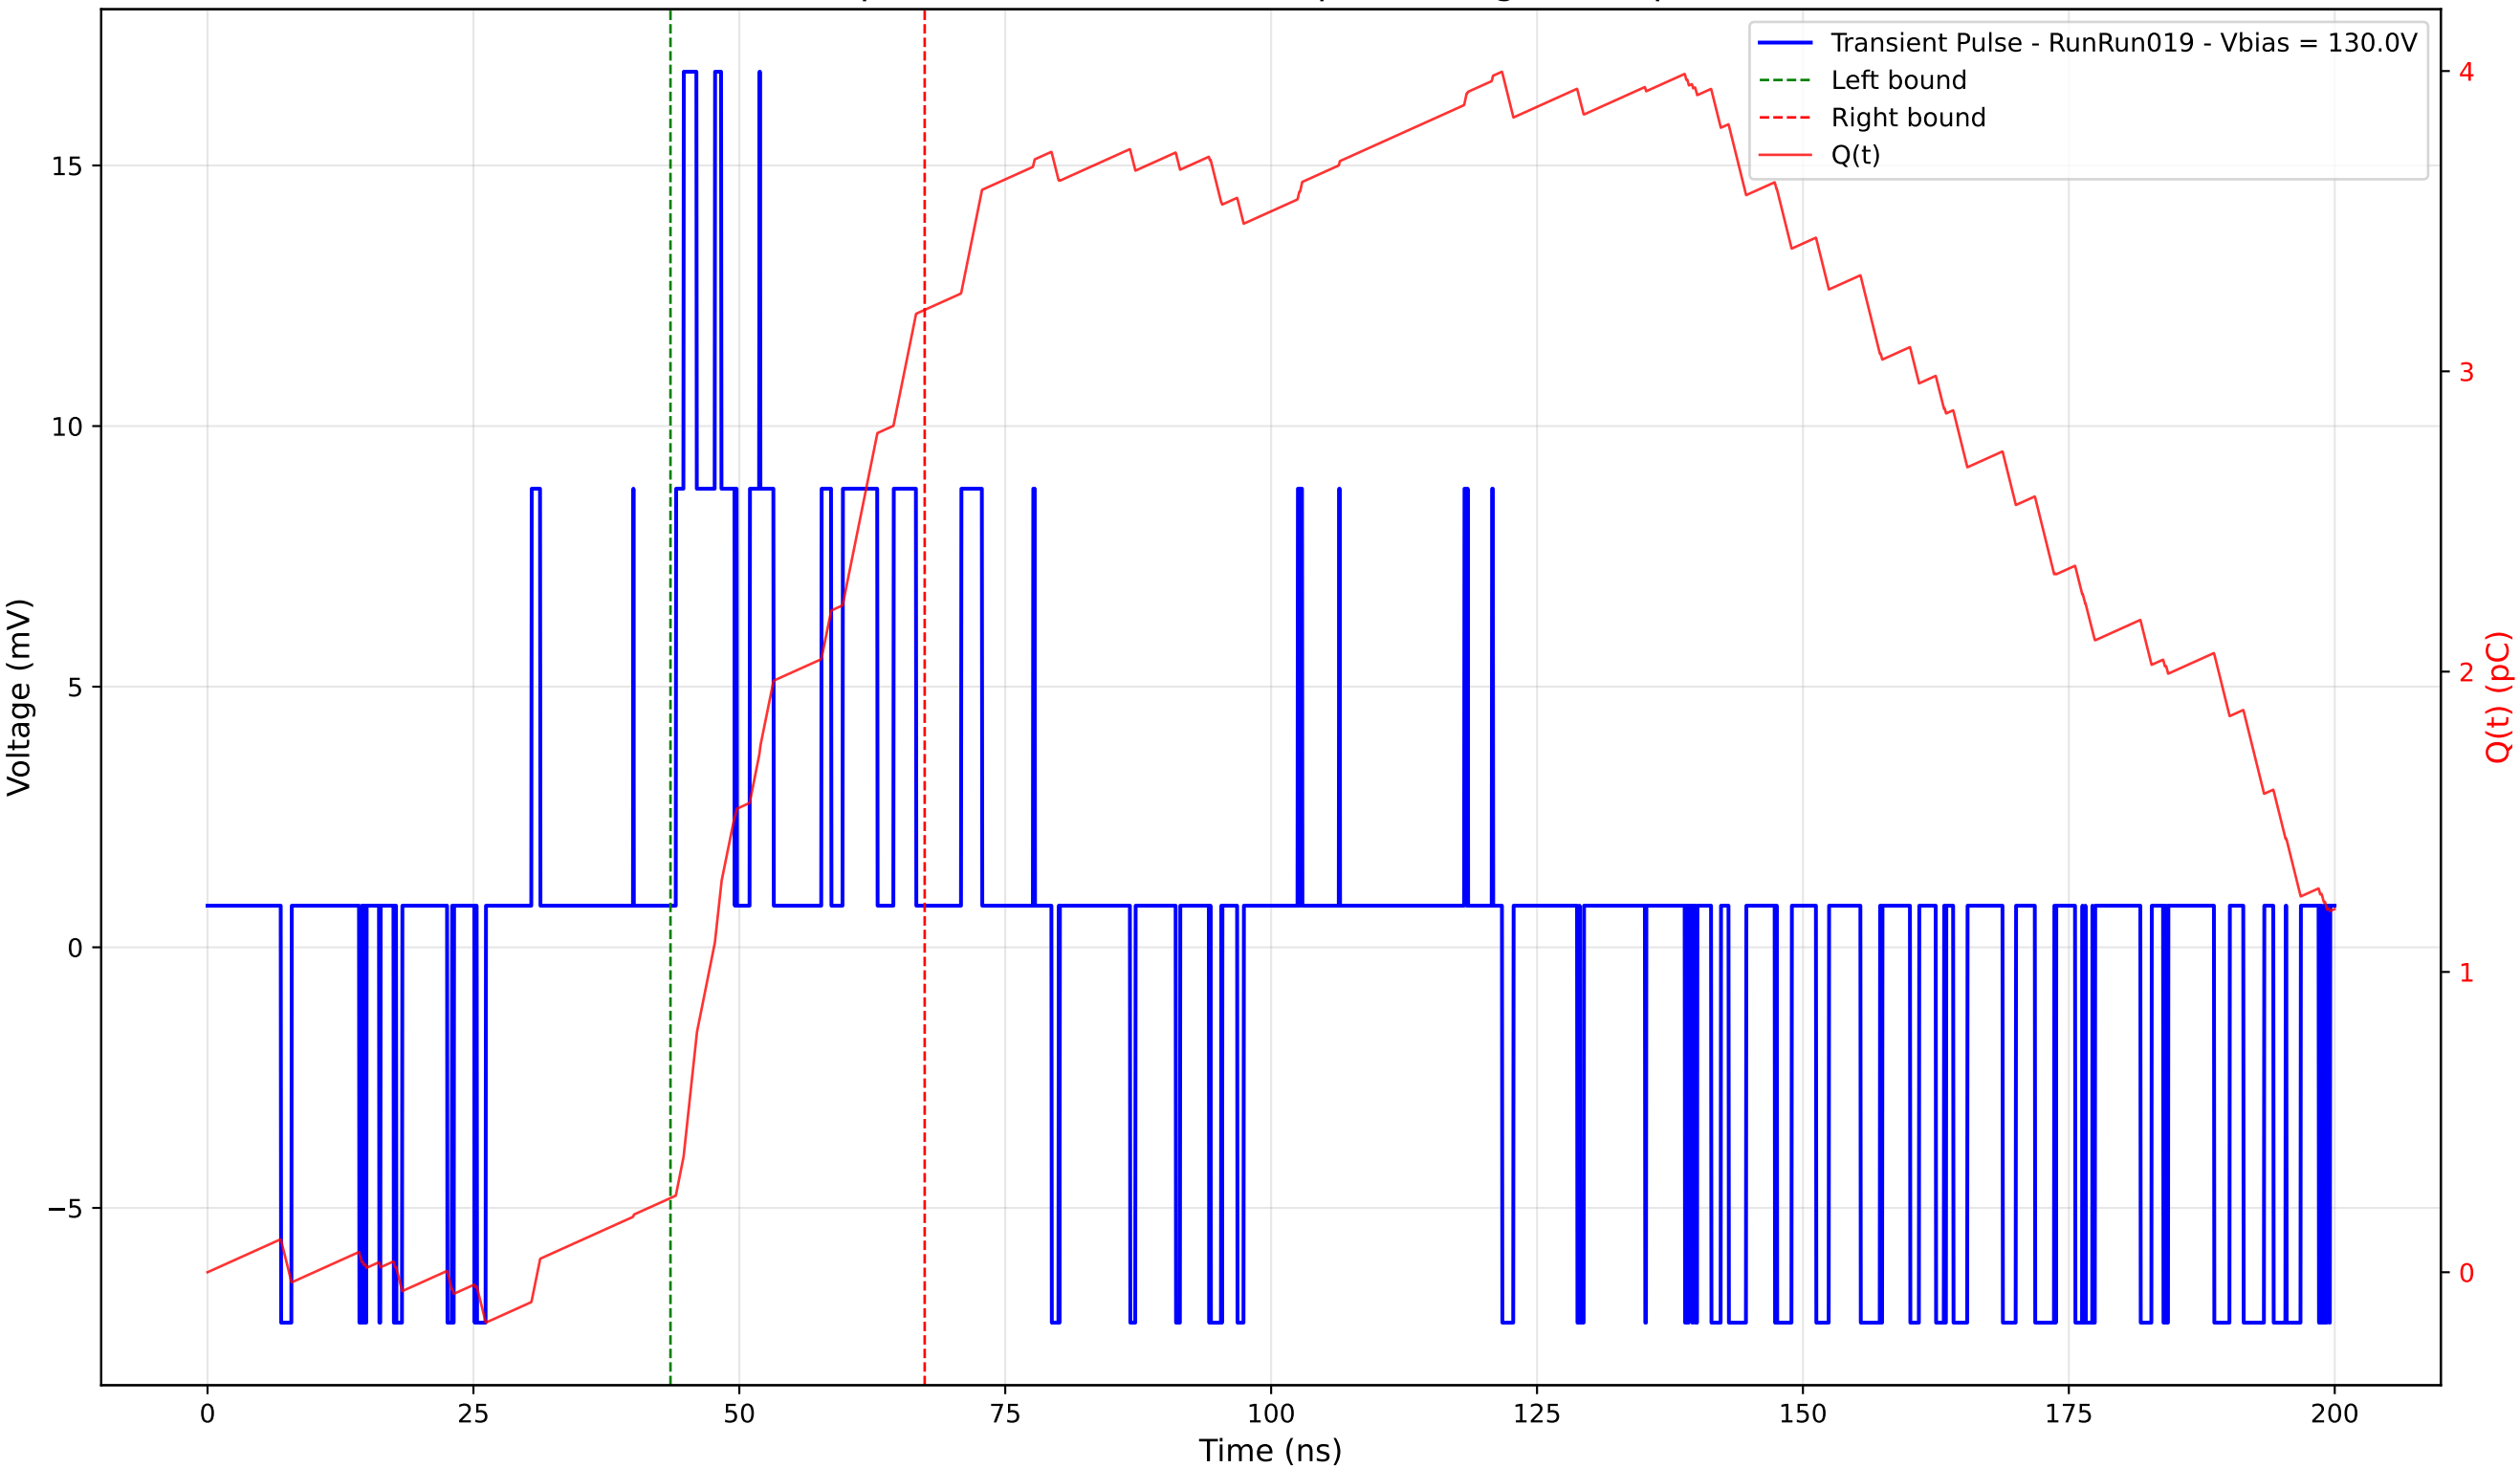


Transient Pulse - Sample: 4003 - Position: 75.0 μm - Charge: 2.01 pC - Rise Time: 0.00 ns (N/A)

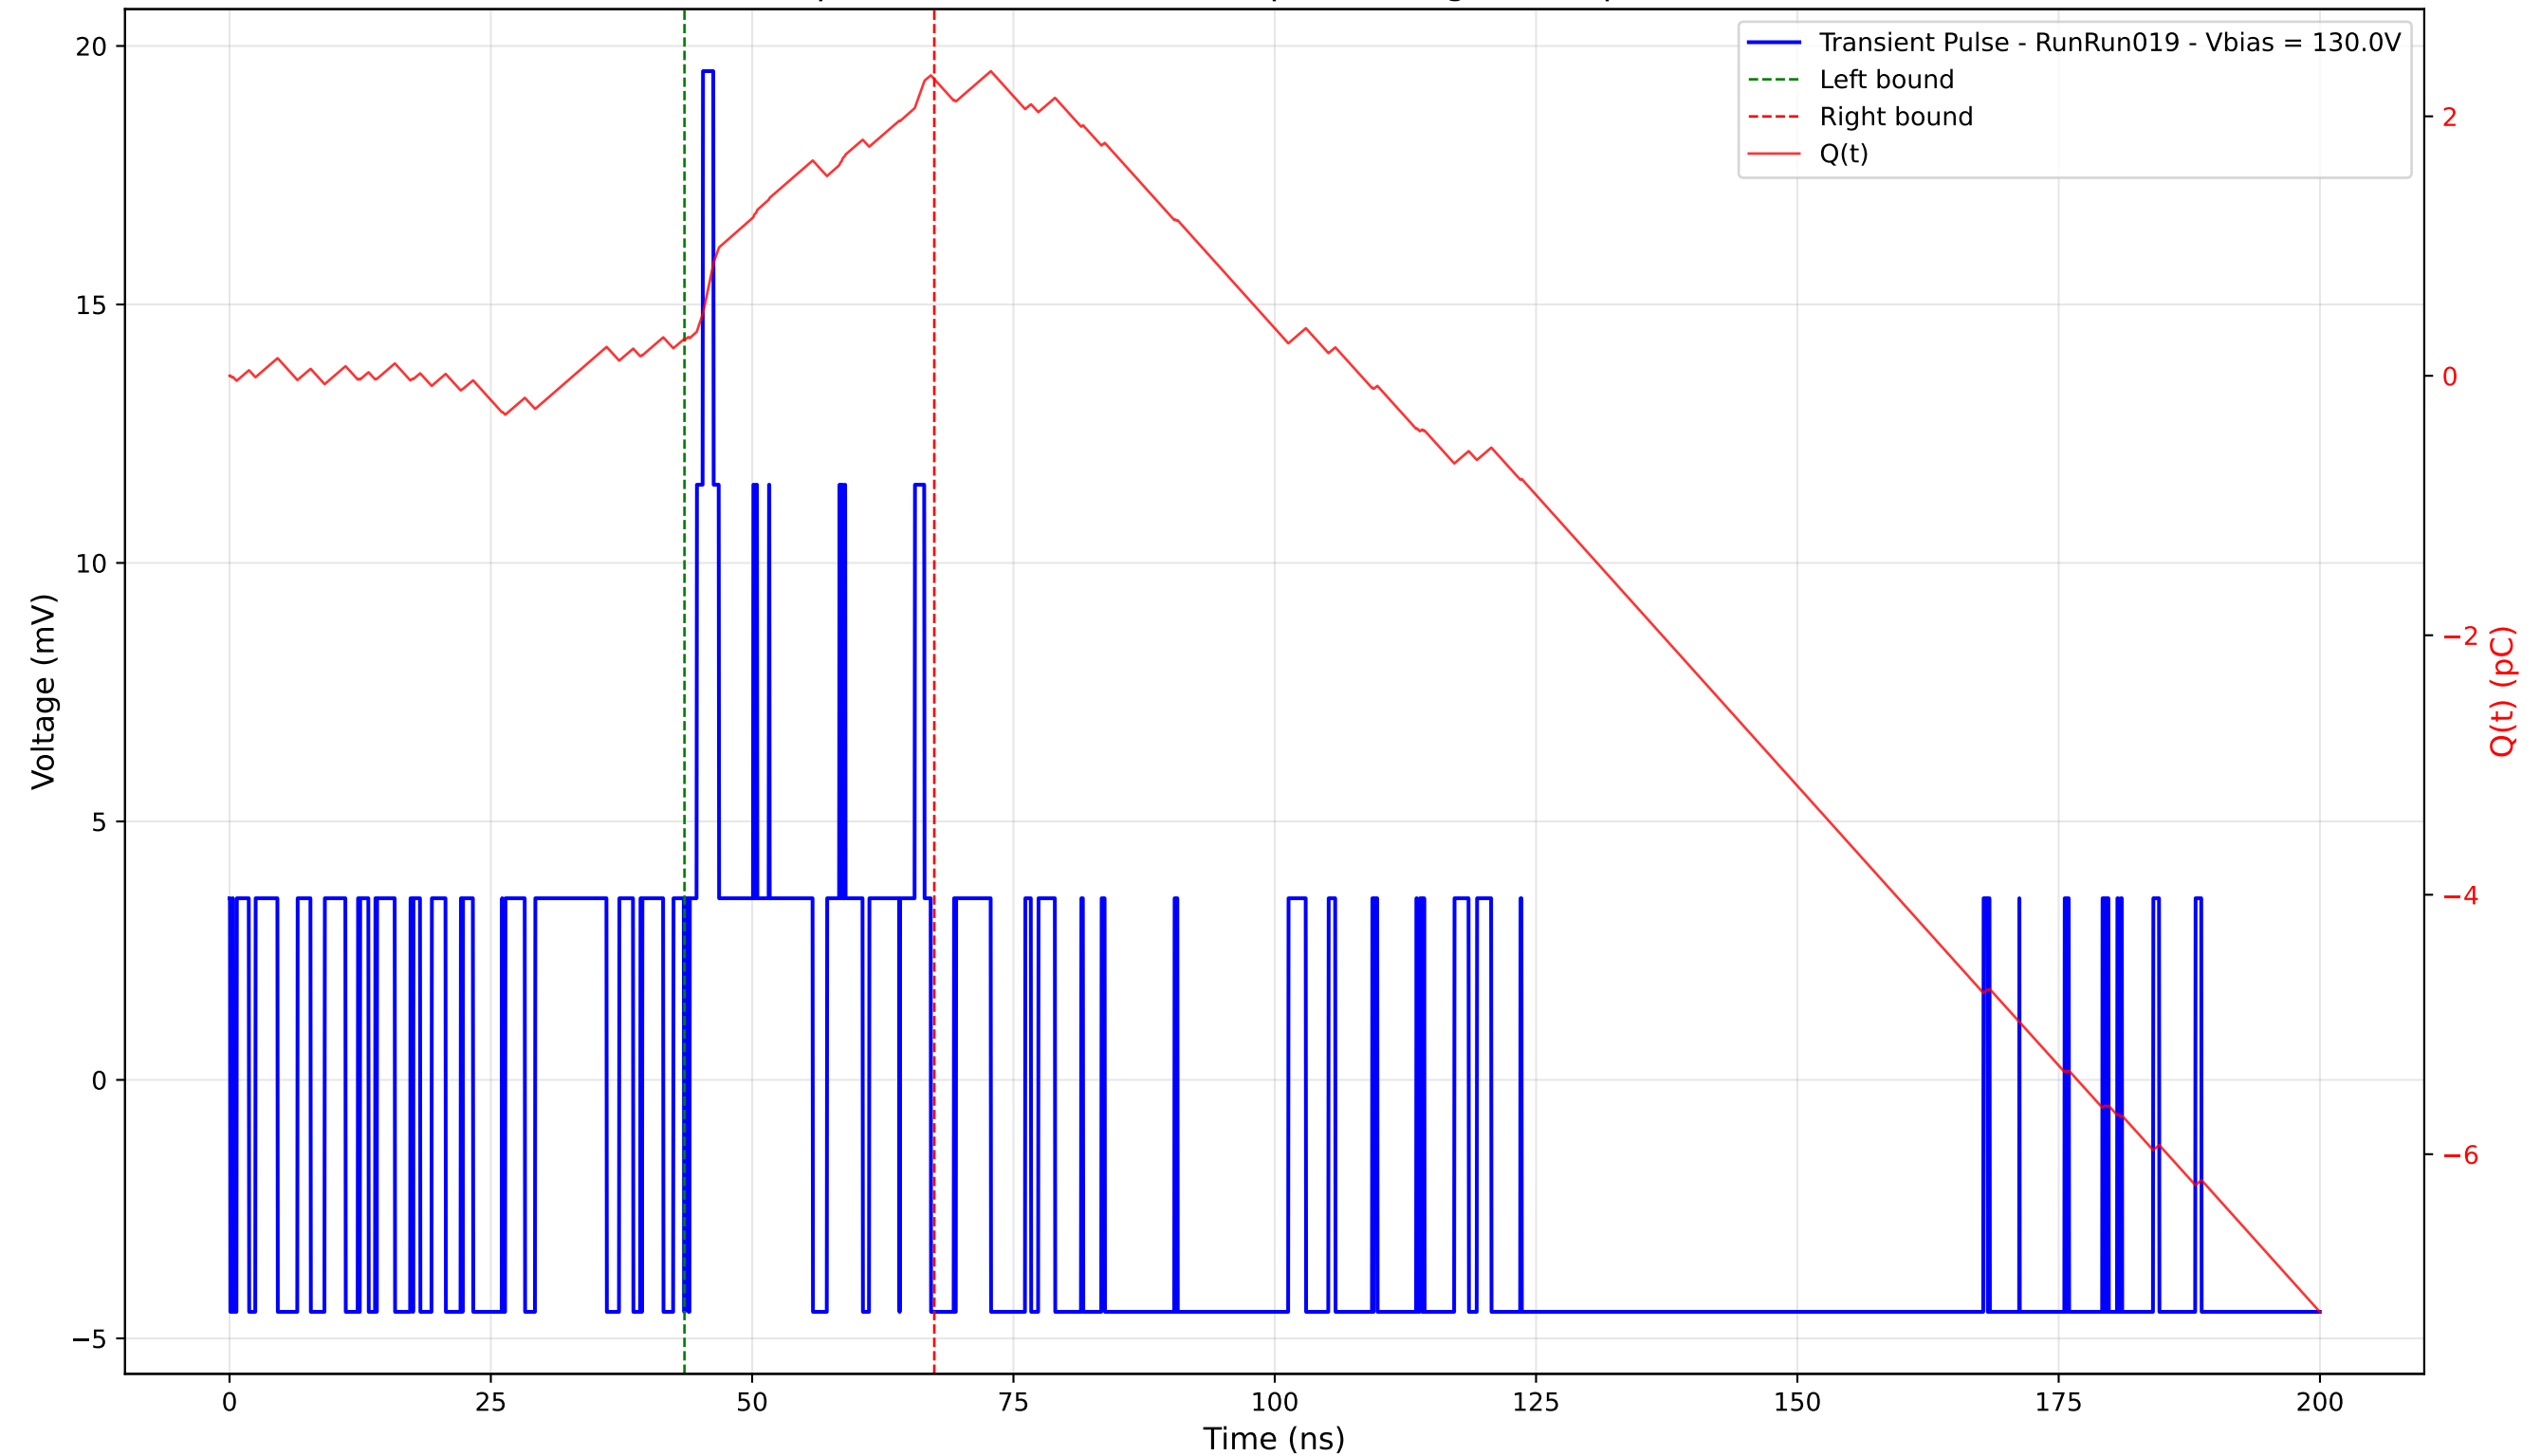


Transient Pulse - Sample: 4003 - Position: 80.0 μm - Charge: 1.52 pC - Rise Time: 0.00 ns (N/A)

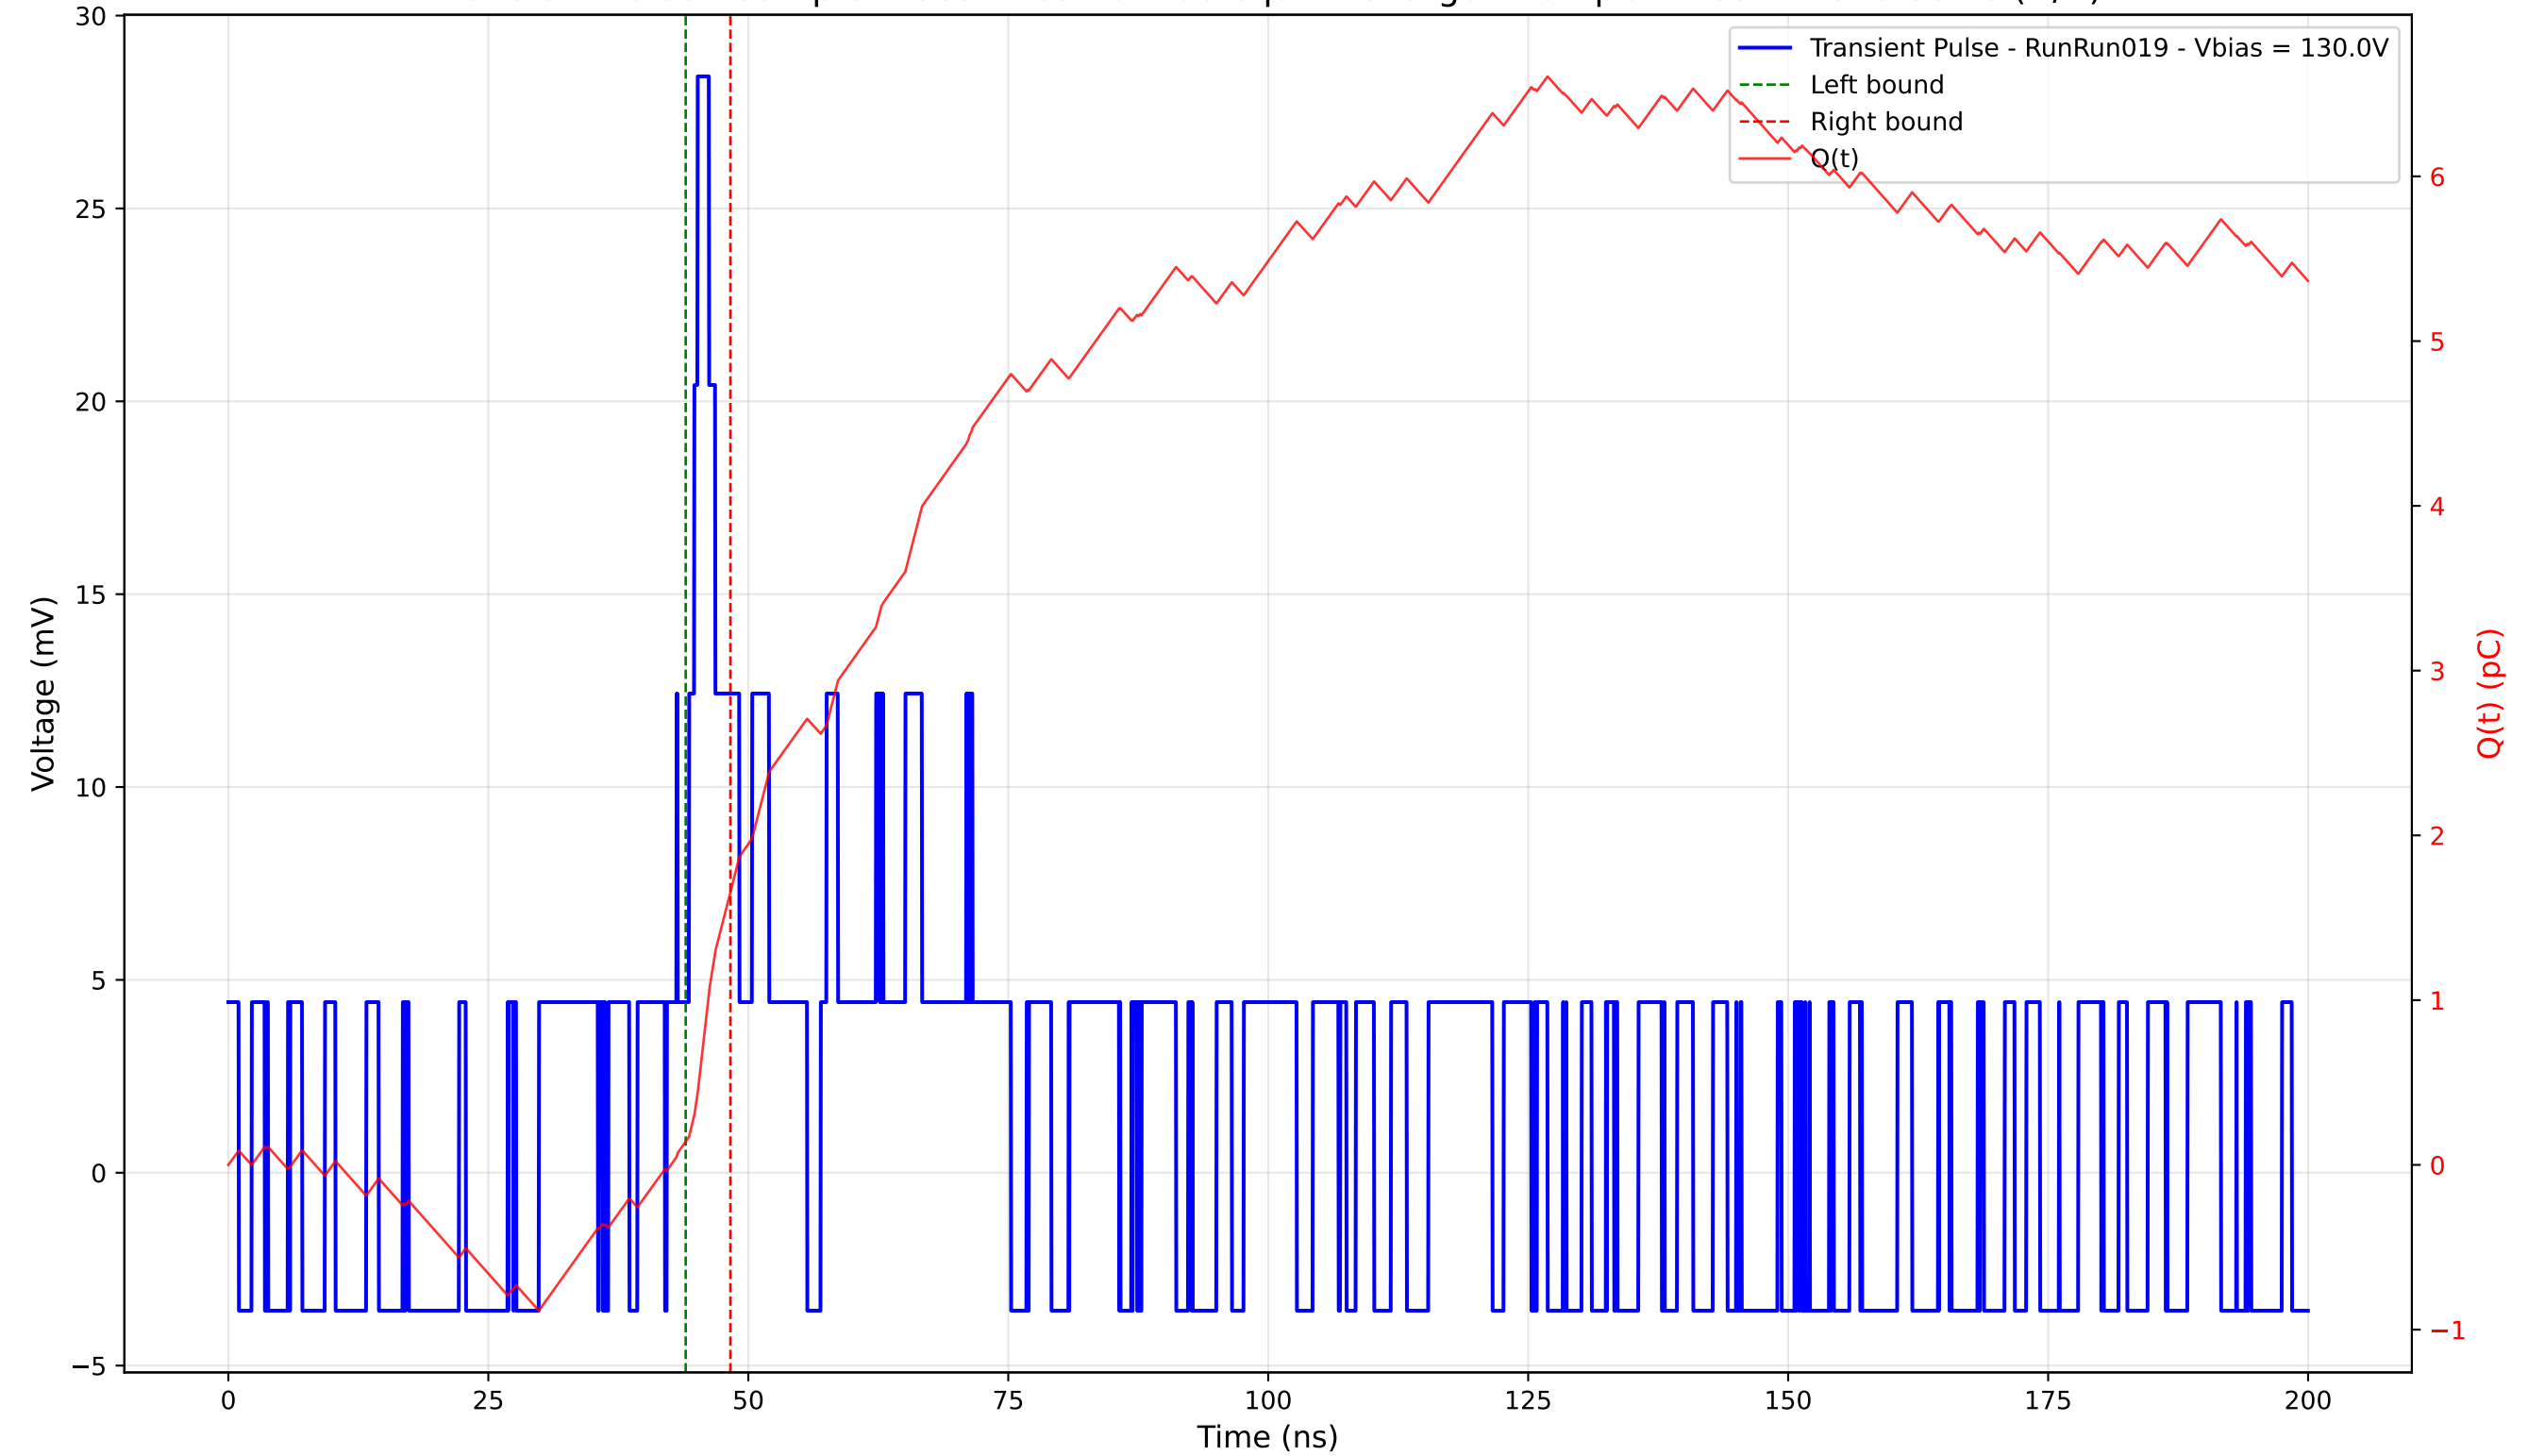


Transient Pulse - Sample: 4003 - Position: 85.0 μm - Charge: 2.77 pC - Rise Time: 1.23 ns

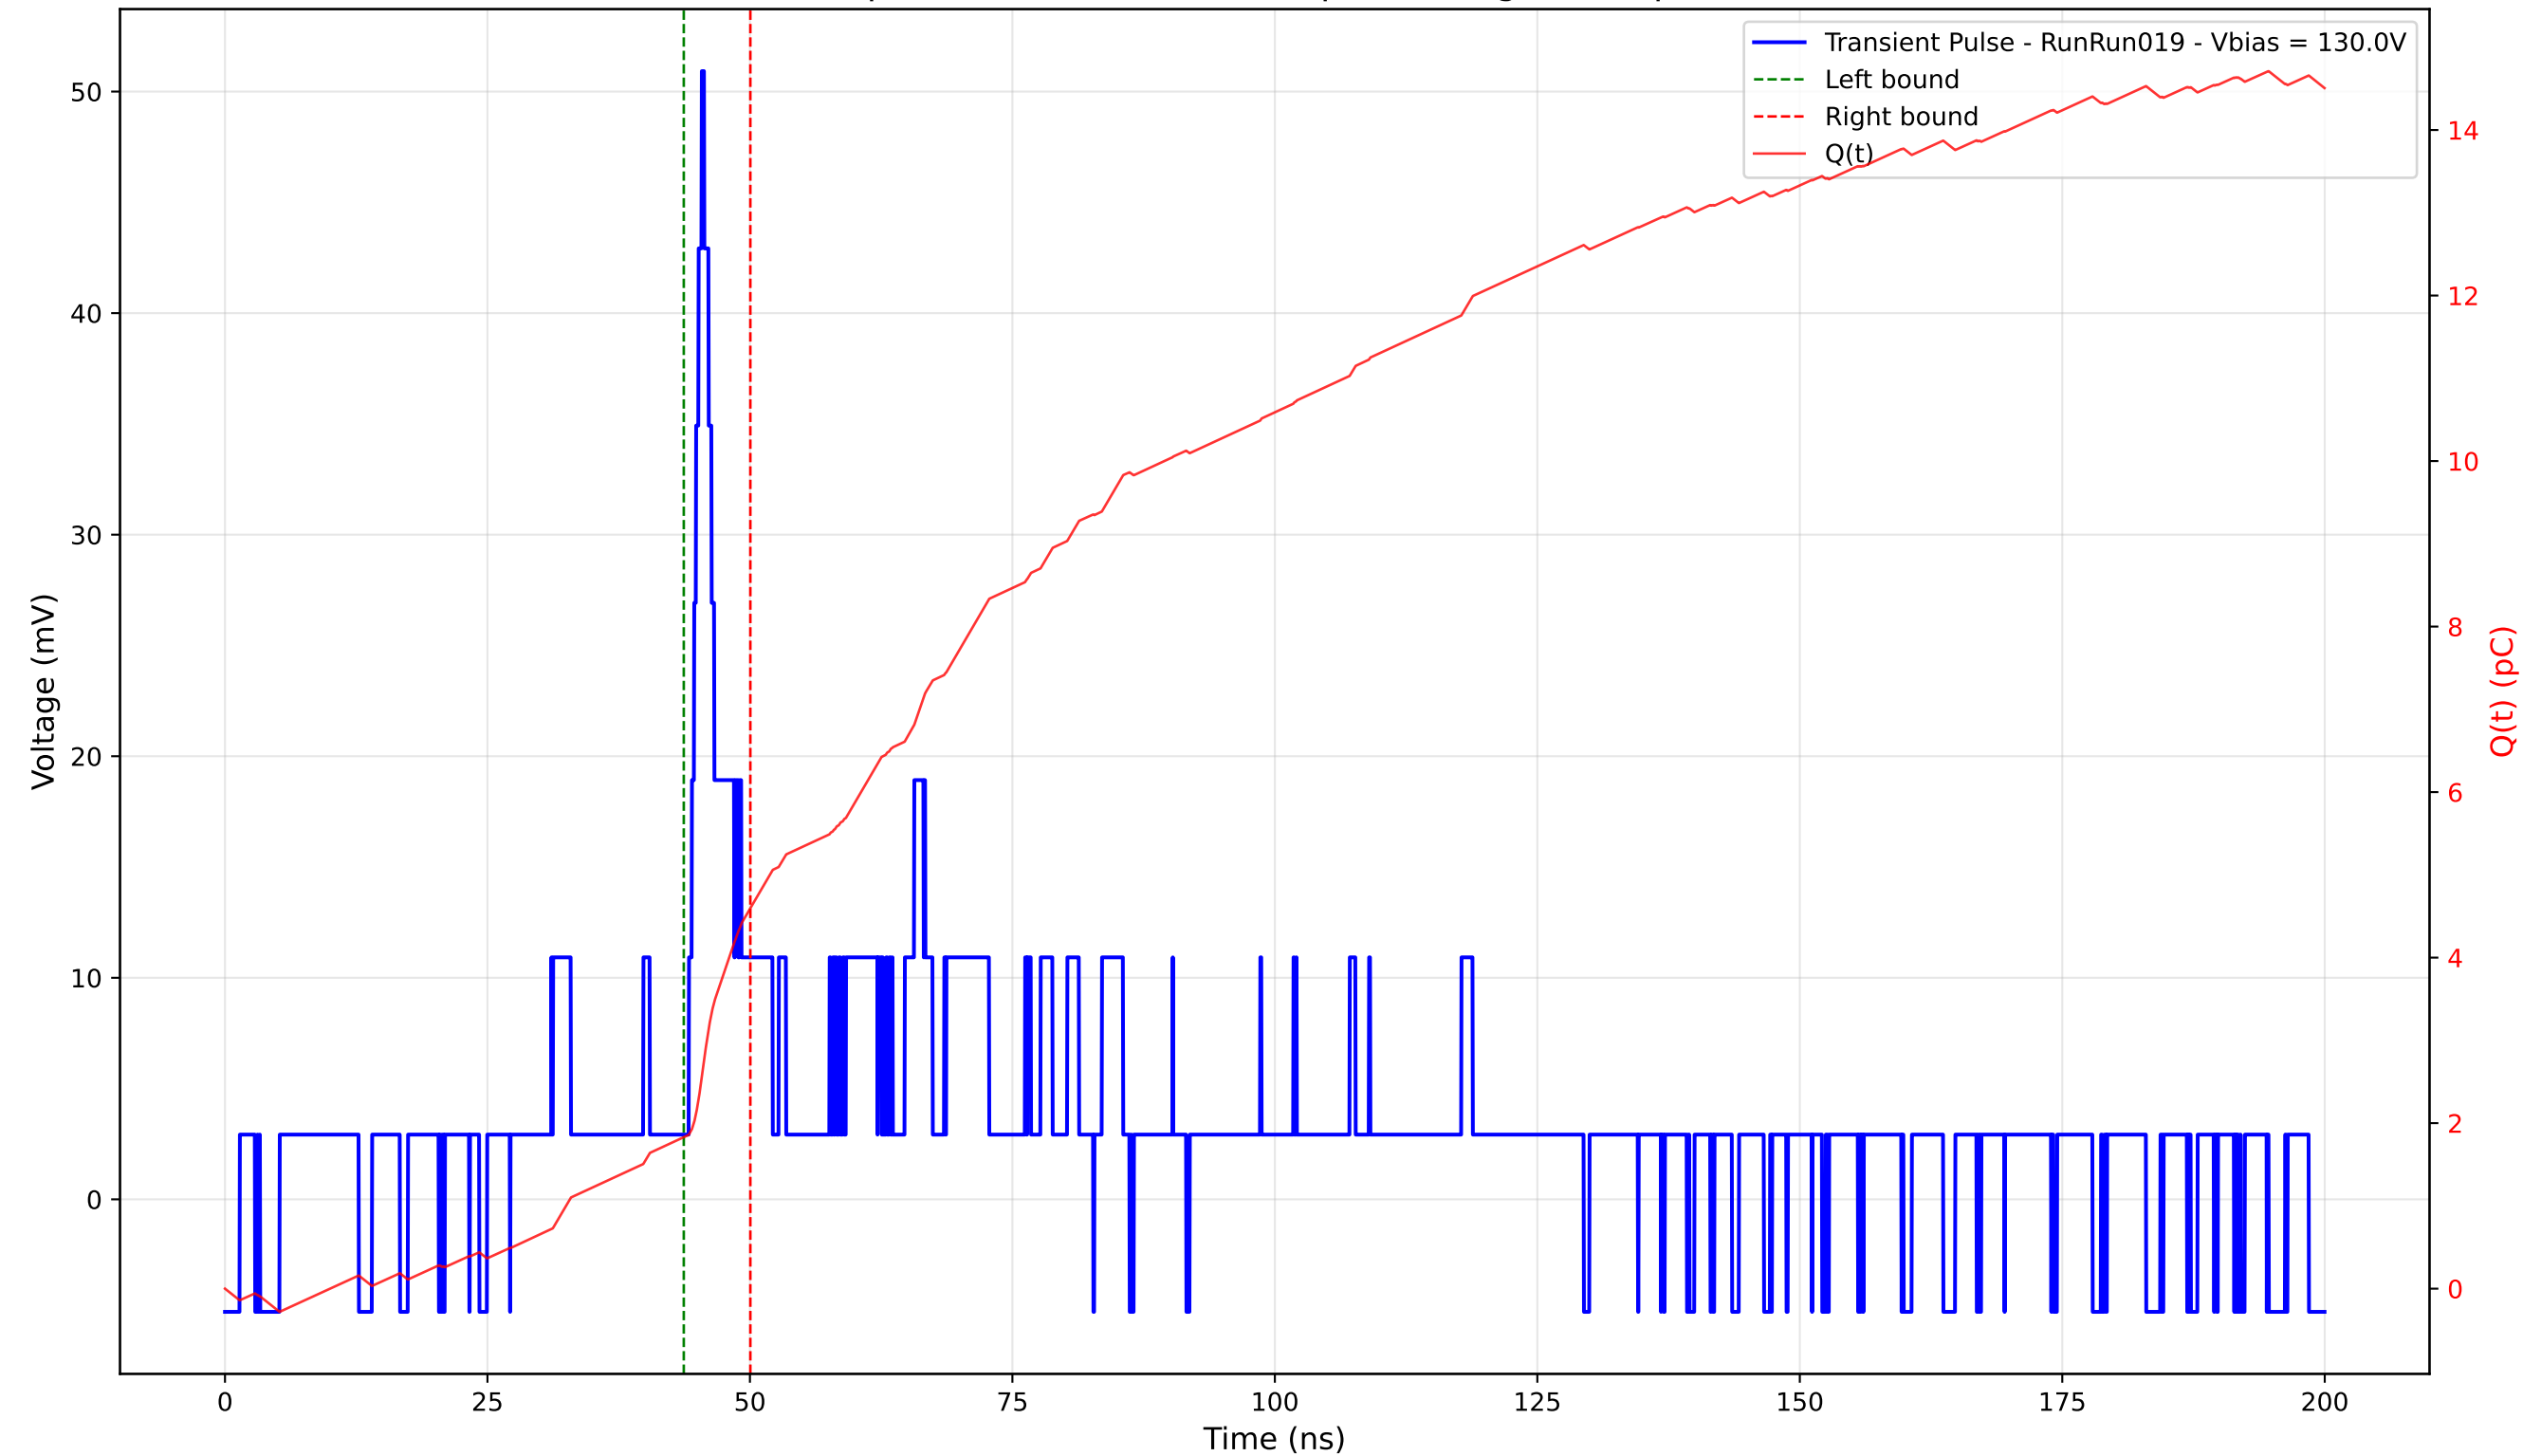


Transient Pulse - Sample: 4003 - Position: 90.0 μm - Charge: 4.79 pC - Rise Time: 0.98 ns

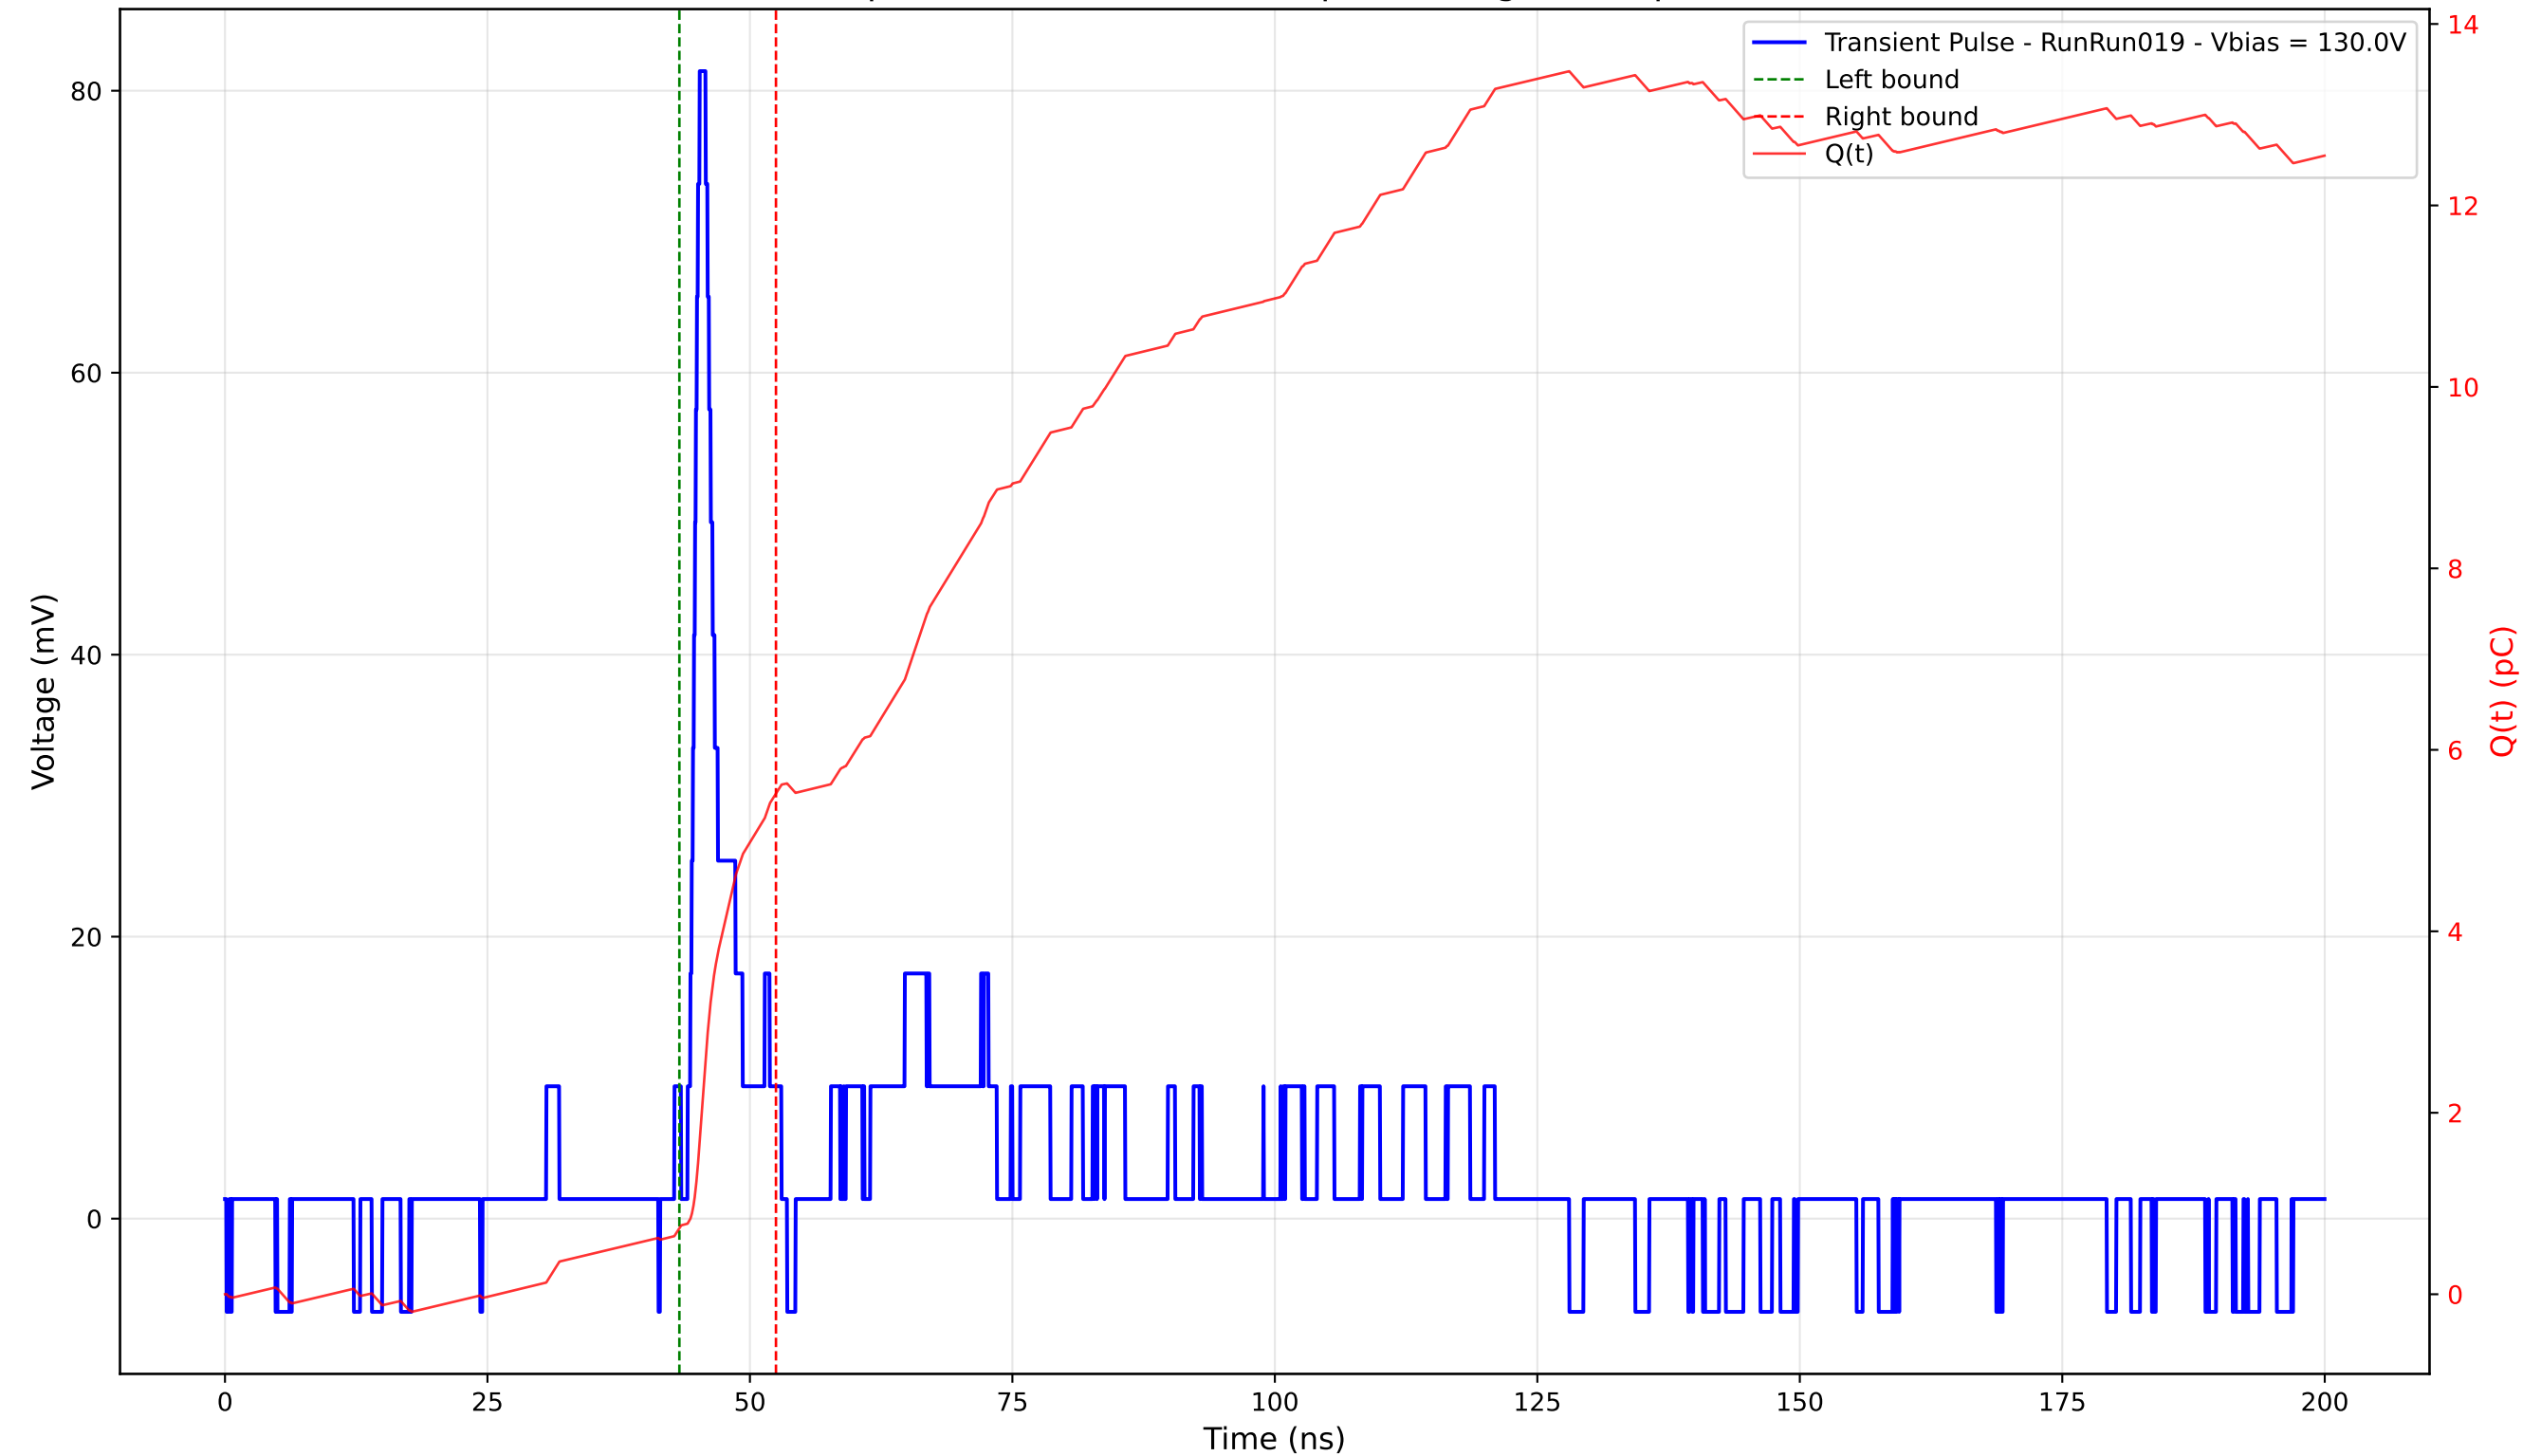


Transient Pulse - Sample: 4003 - Position: 95.0 μm - Charge: 6.85 pC - Rise Time: 0.93 ns

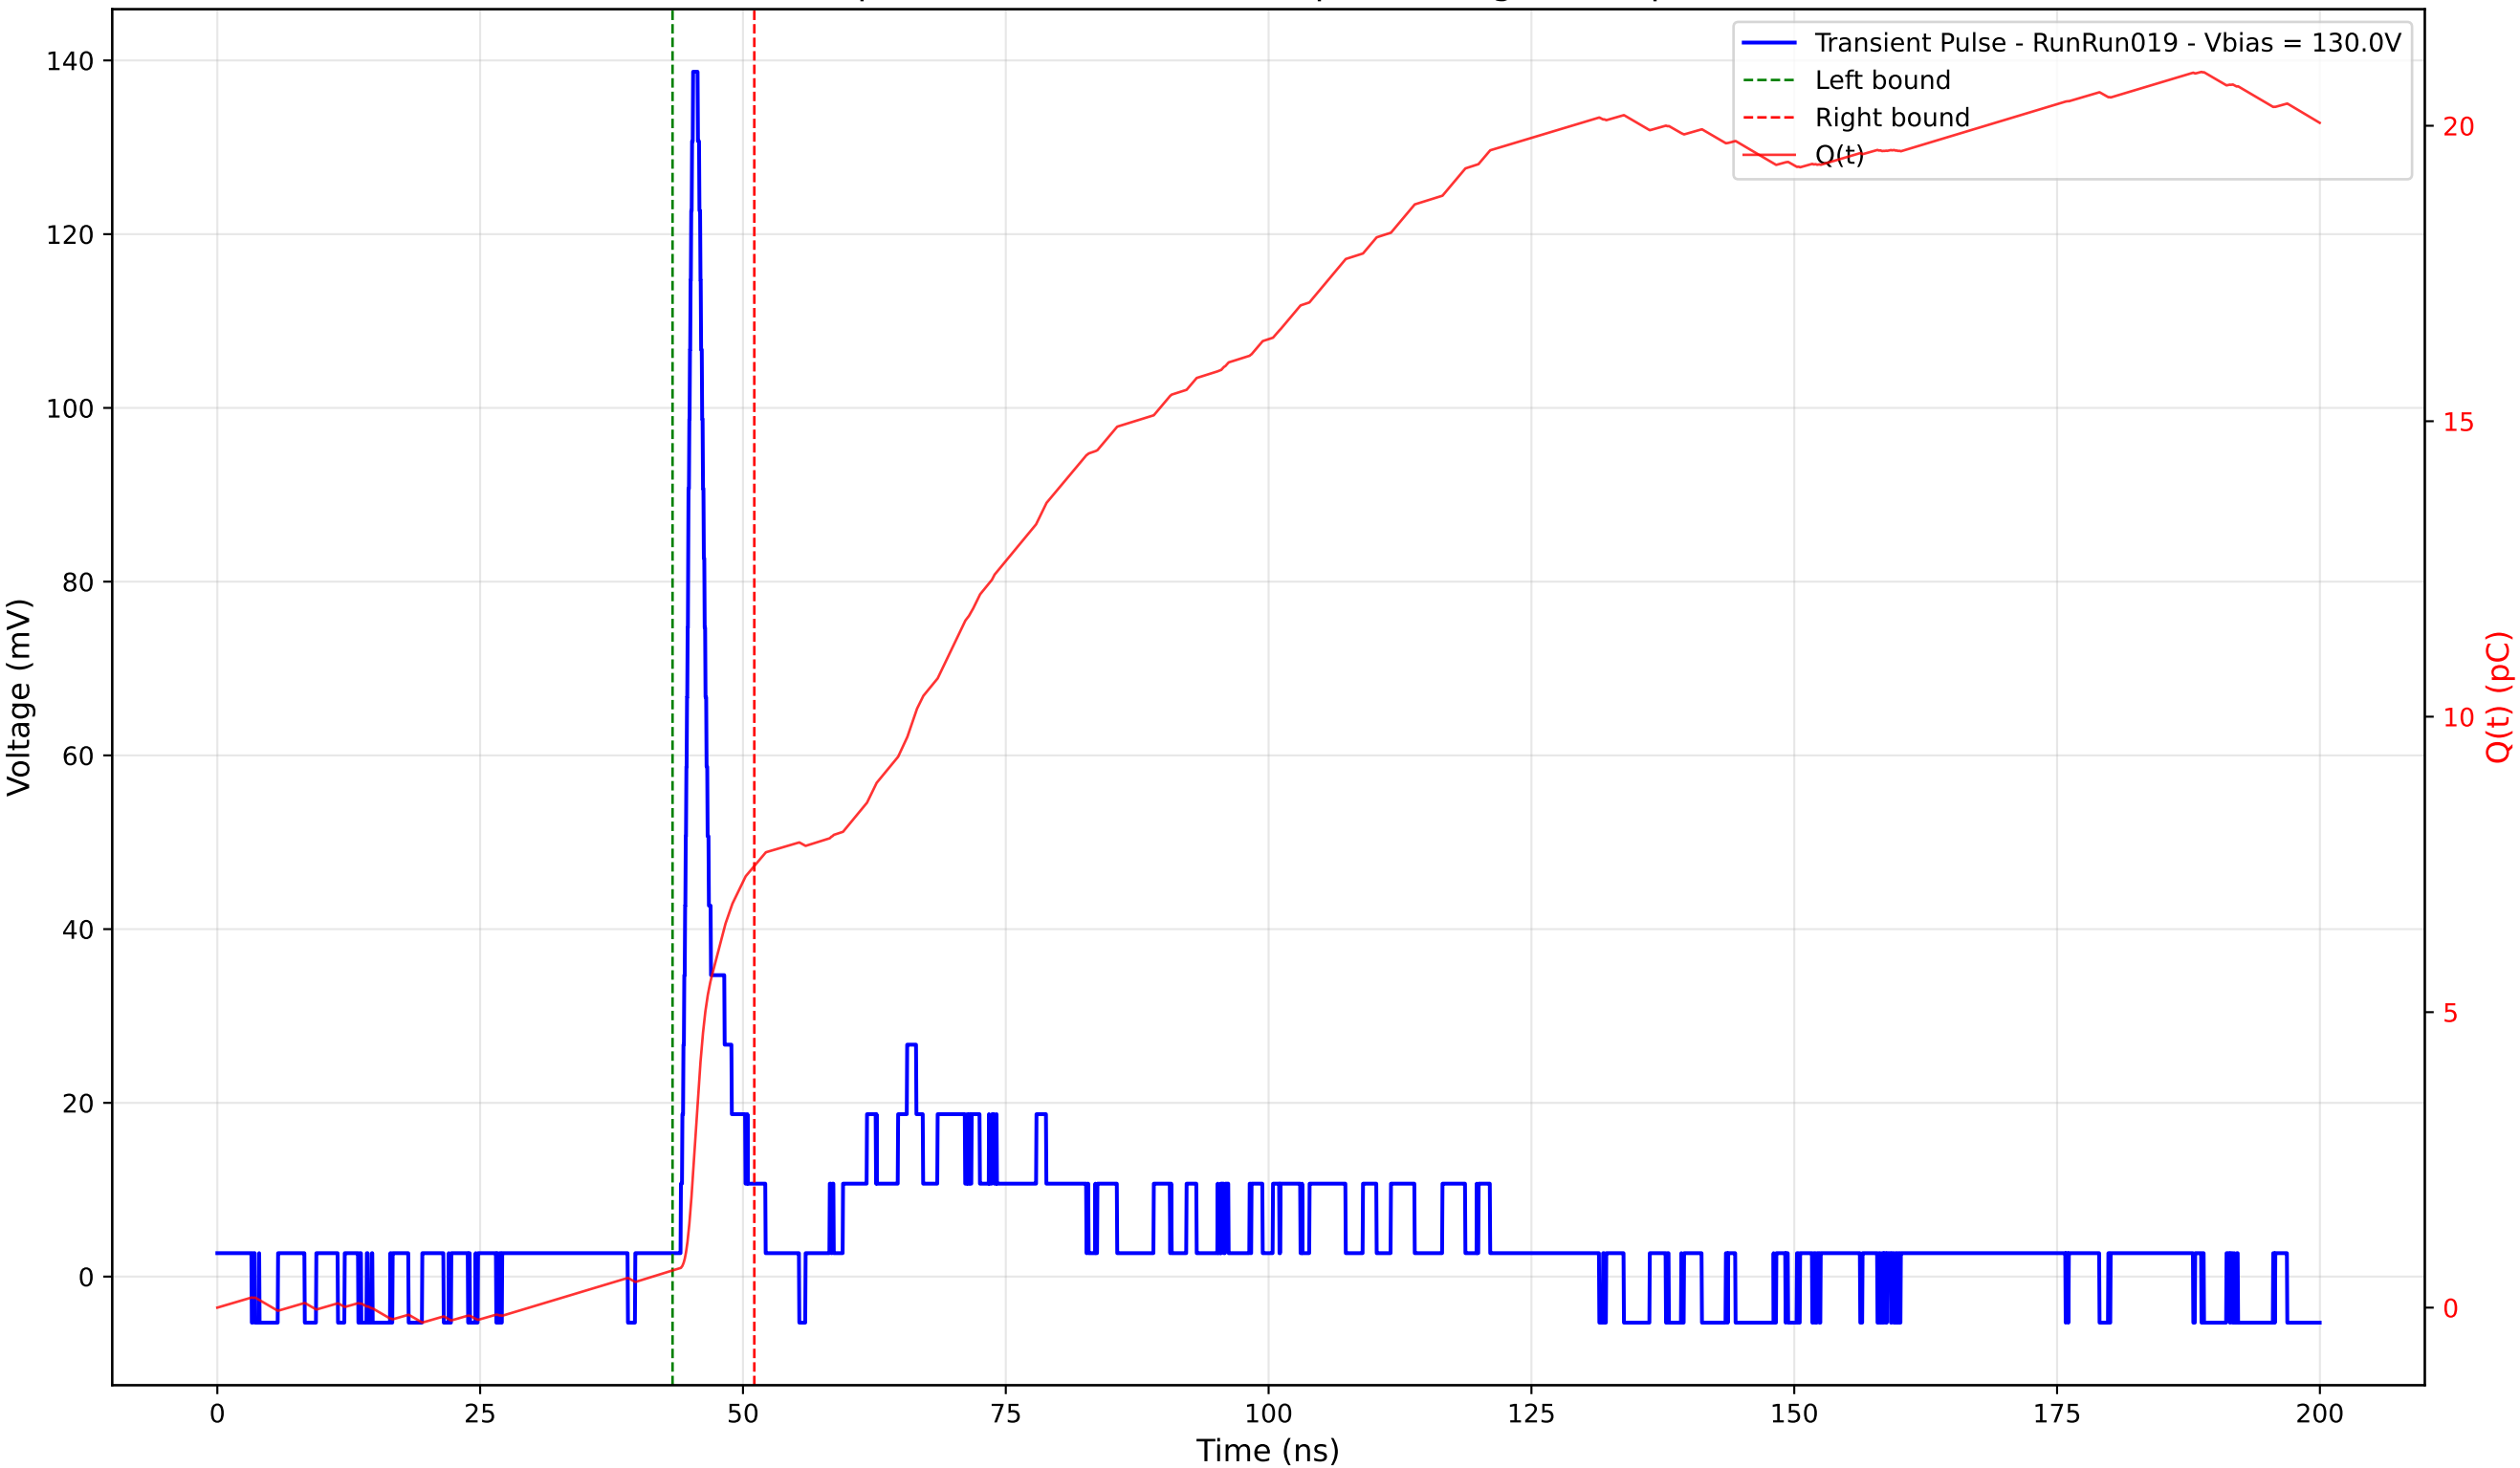


Transient Pulse - Sample: 4003 - Position: 100.0 μm - Charge: 9.35 pC - Rise Time: 0.93 ns

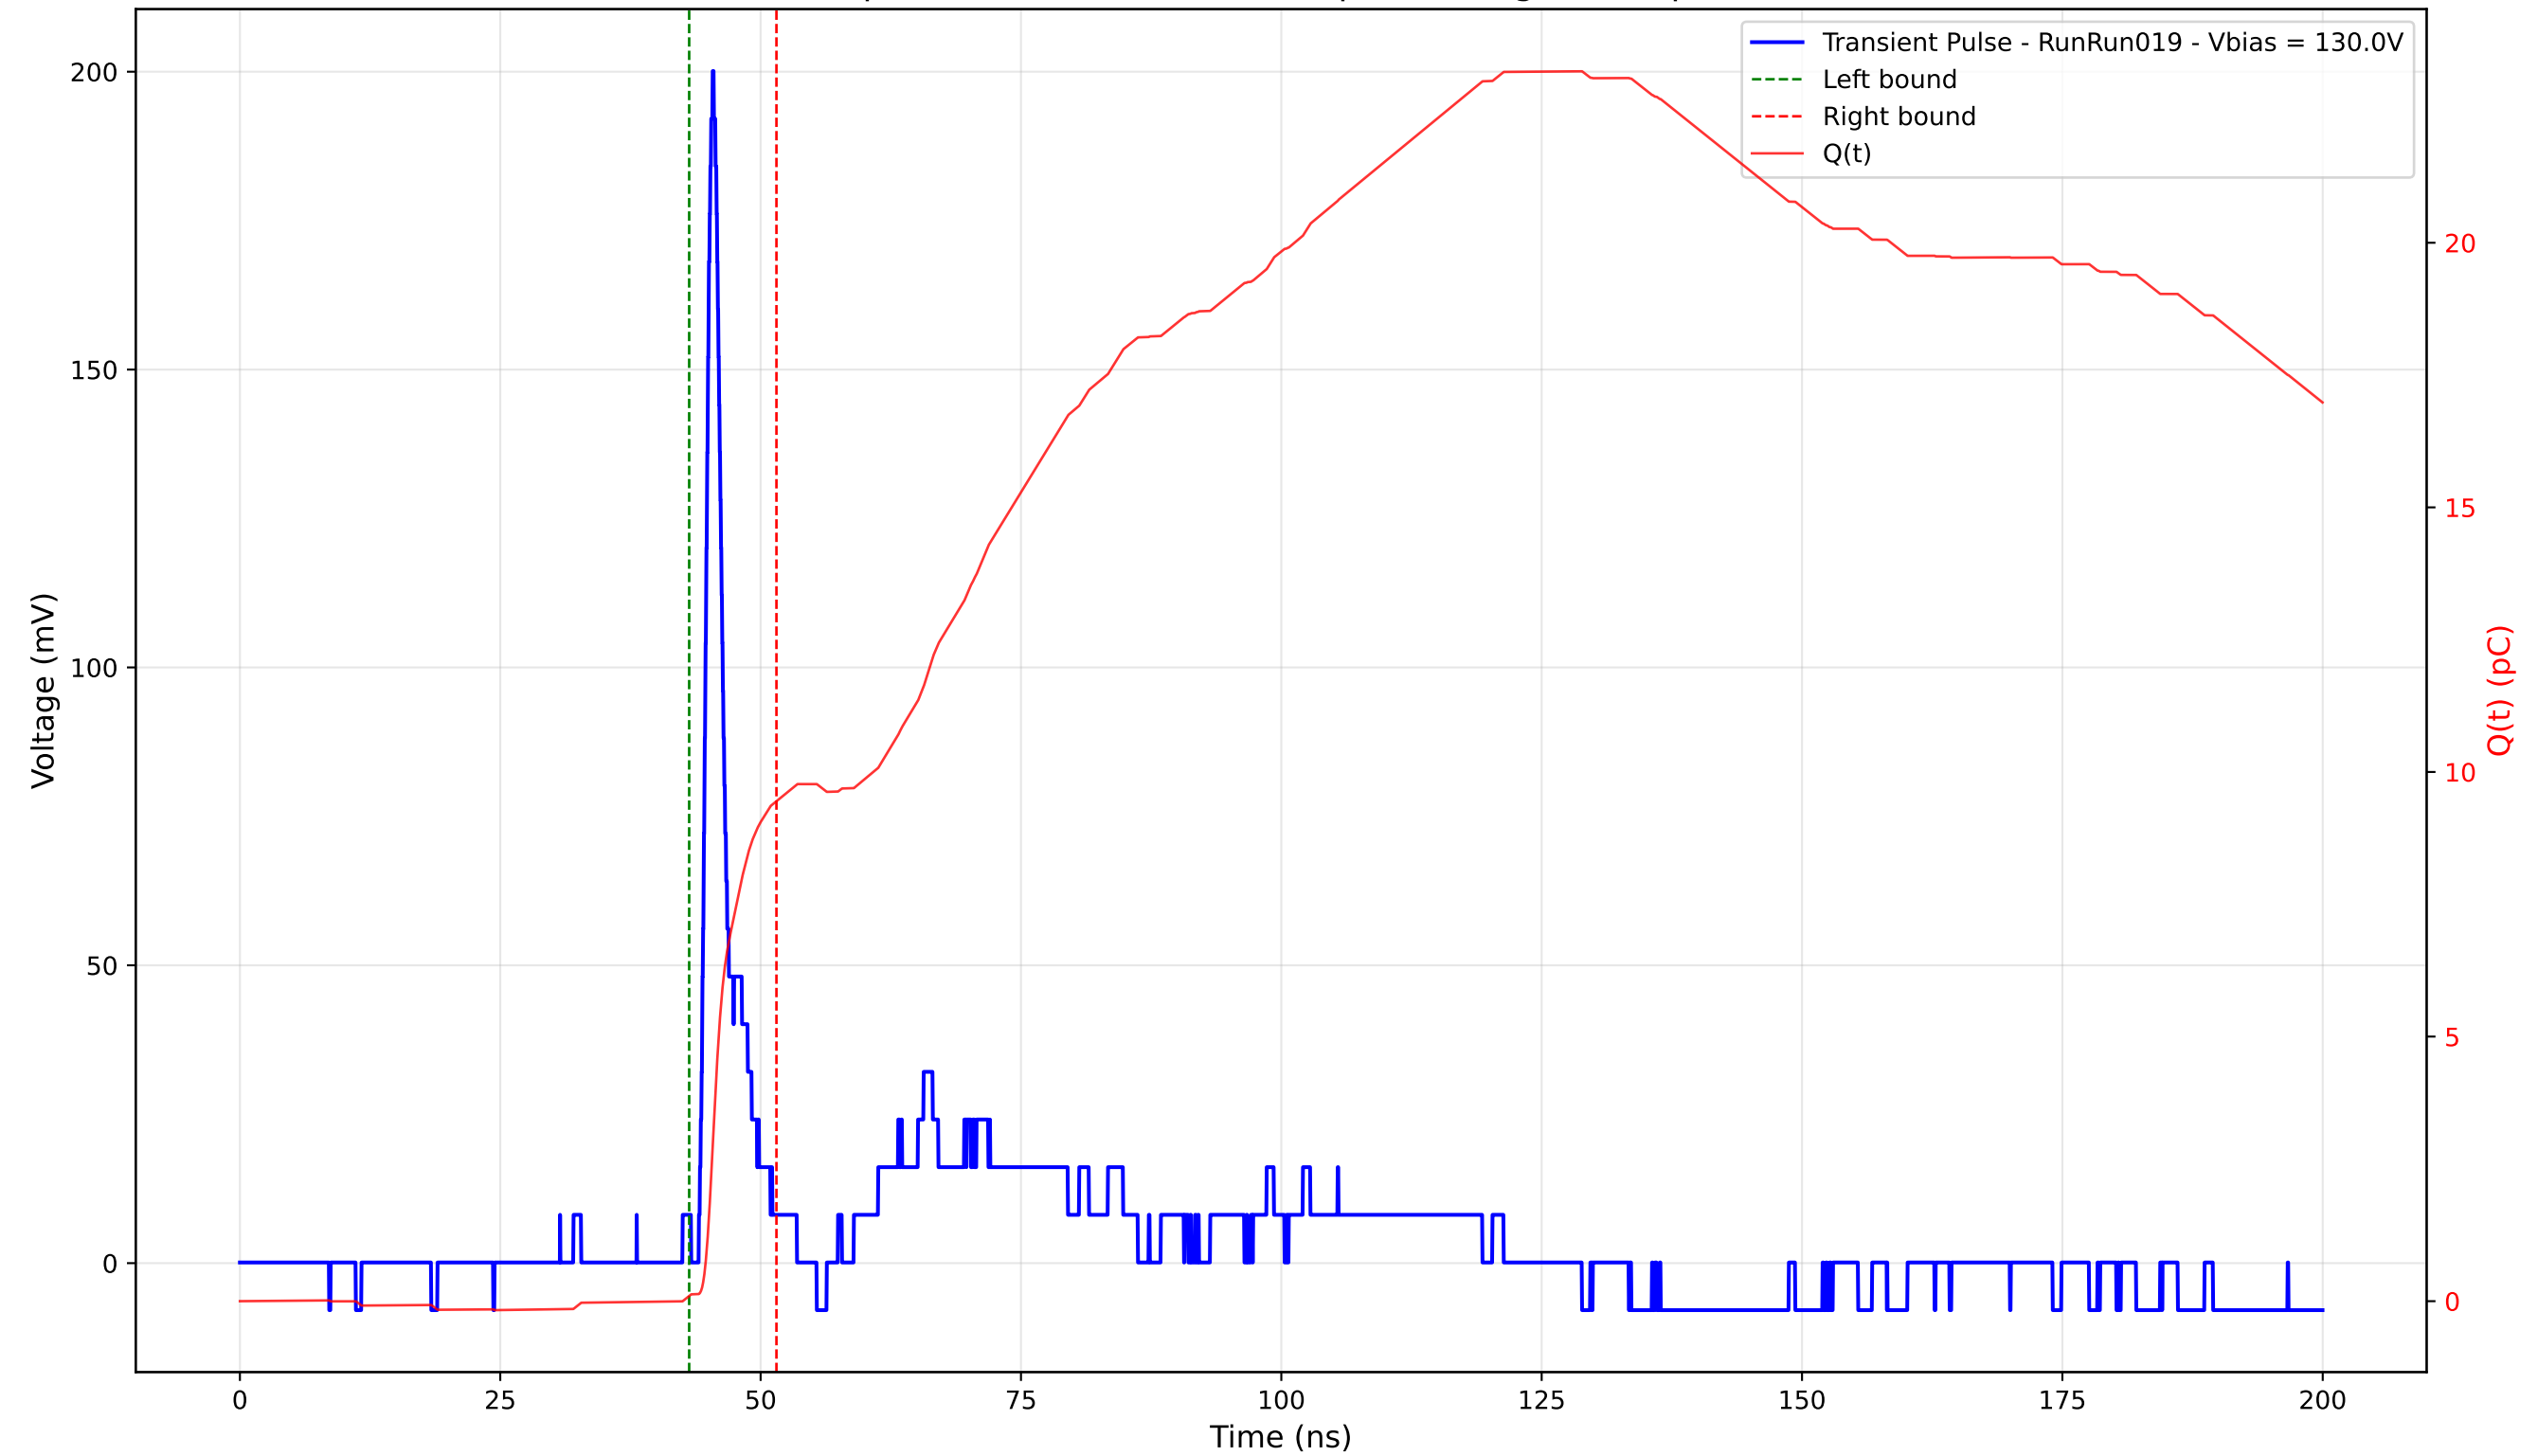


Transient Pulse - Sample: 4003 - Position: 105.0 μm - Charge: 12.49 pC - Rise Time: 0.90 ns

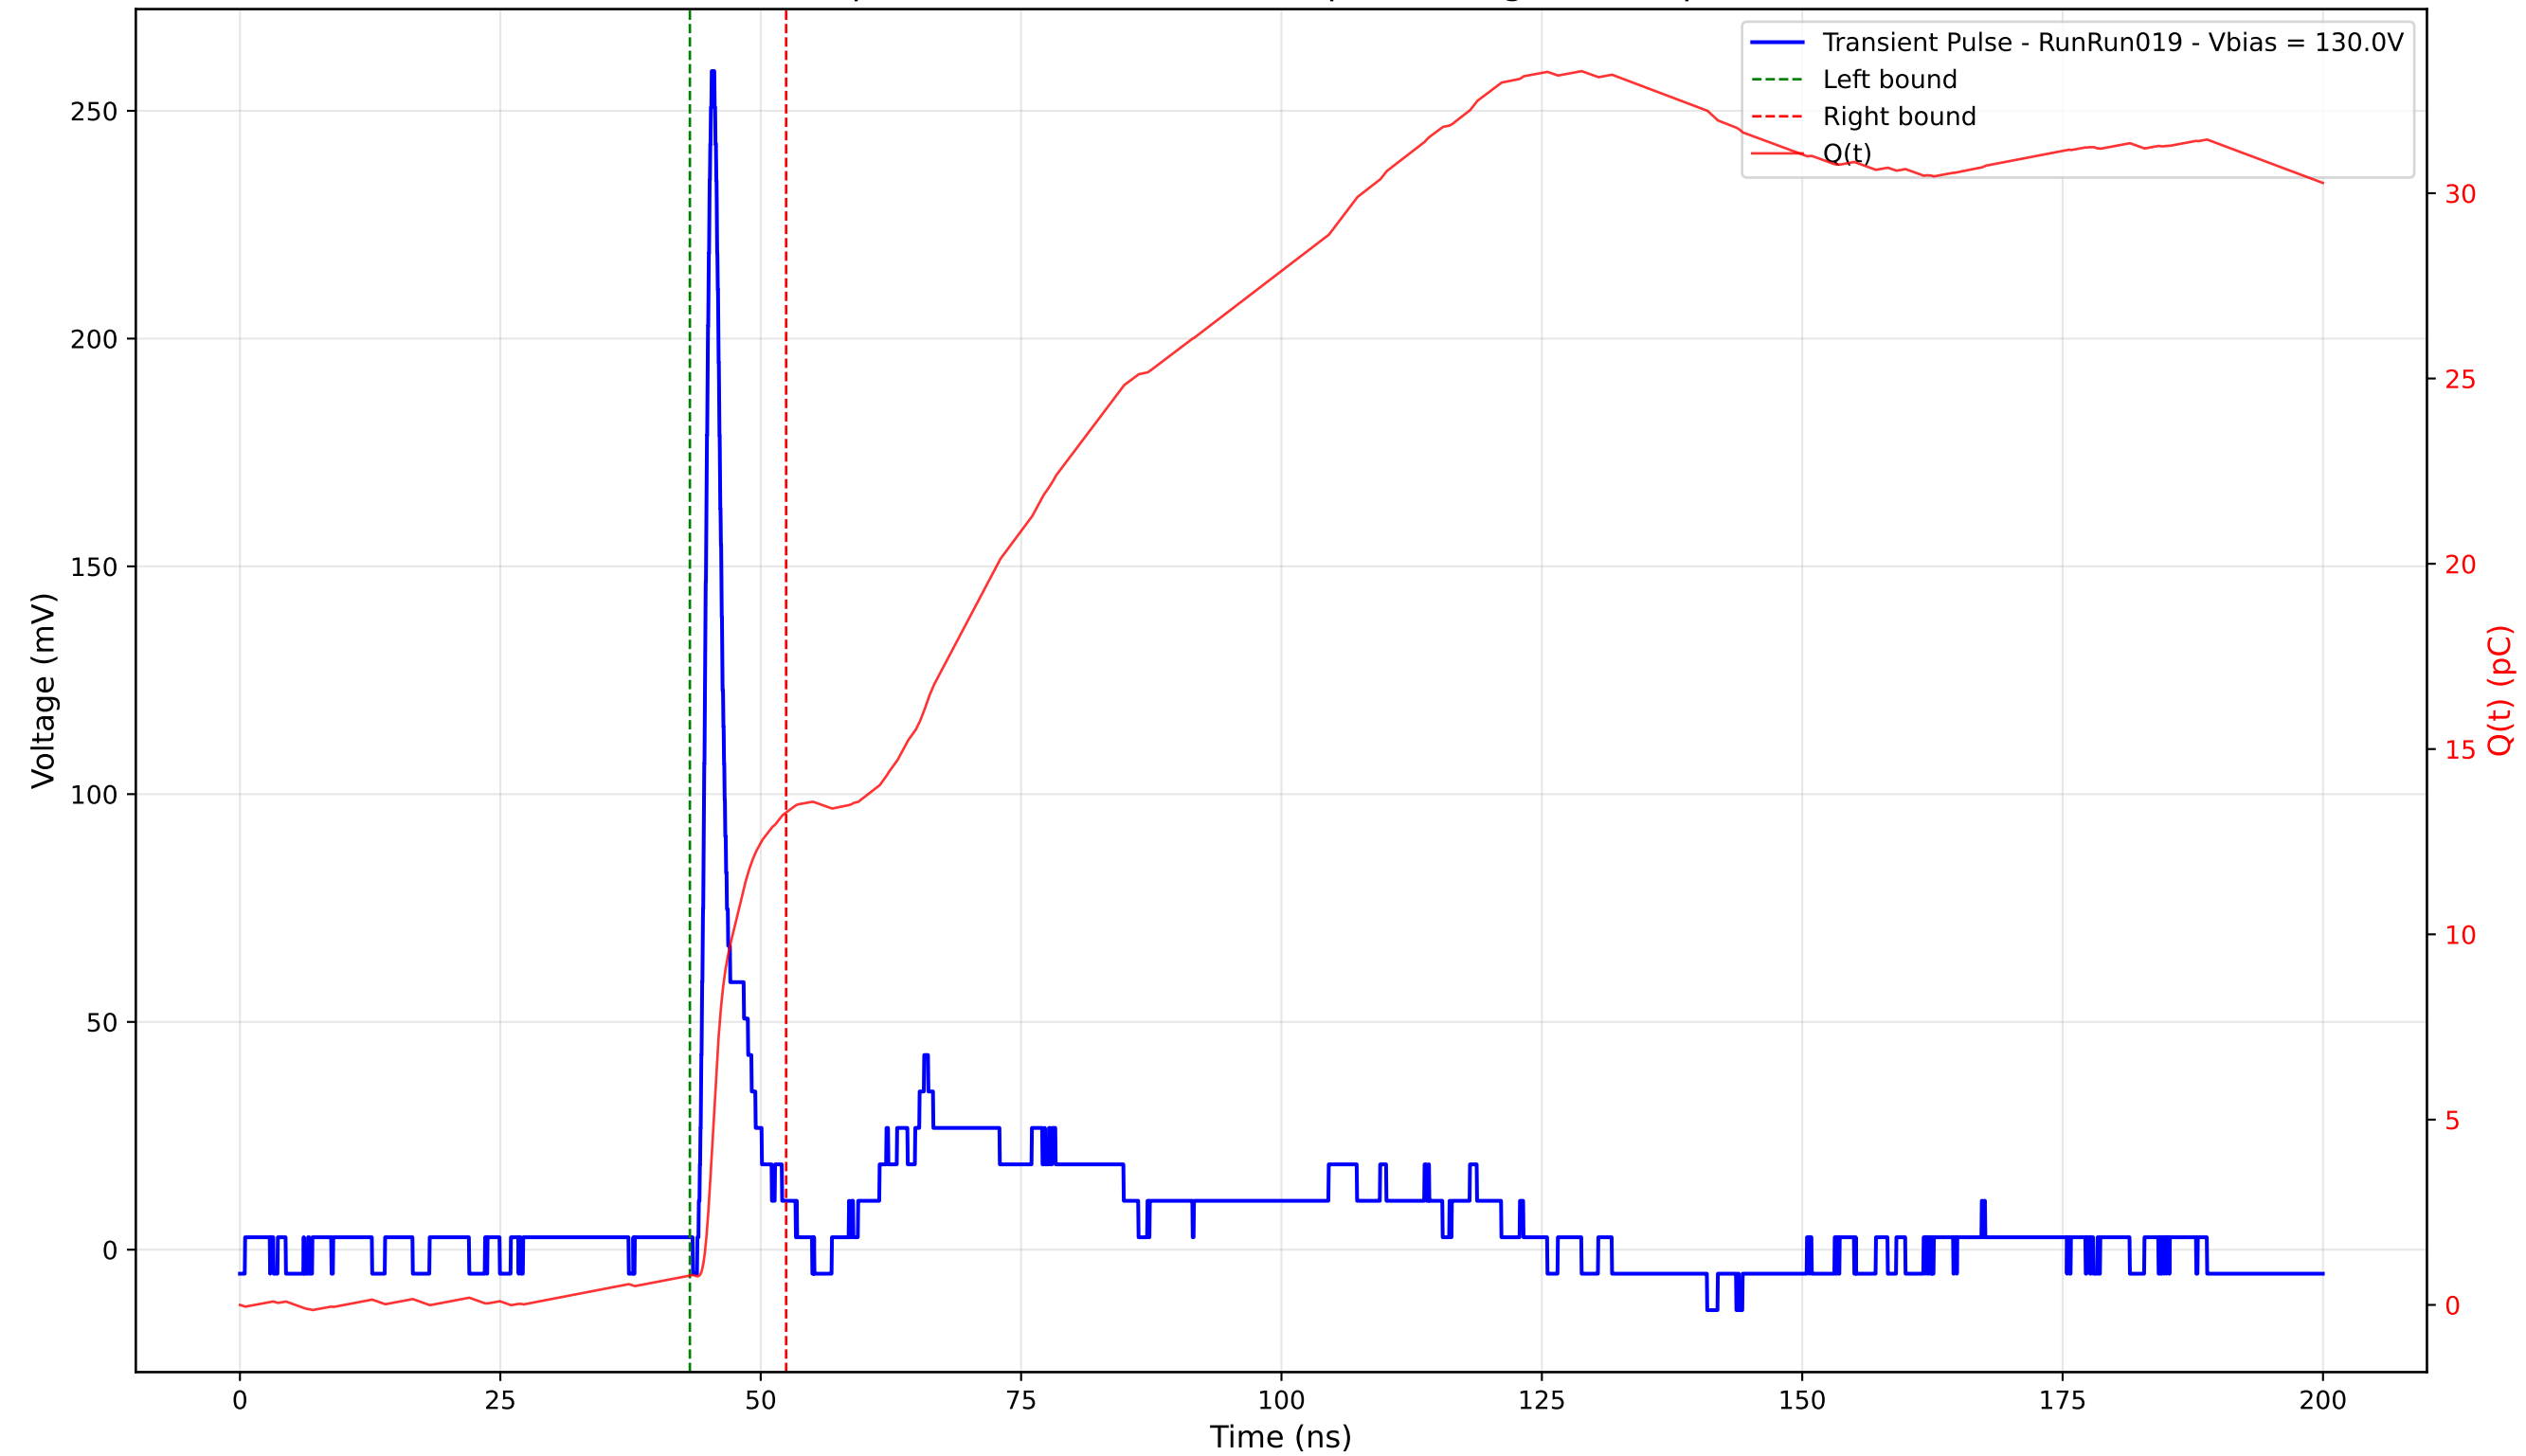


Transient Pulse - Sample: 4003 - Position: 110.0 μm - Charge: 15.08 pC - Rise Time: 0.88 ns

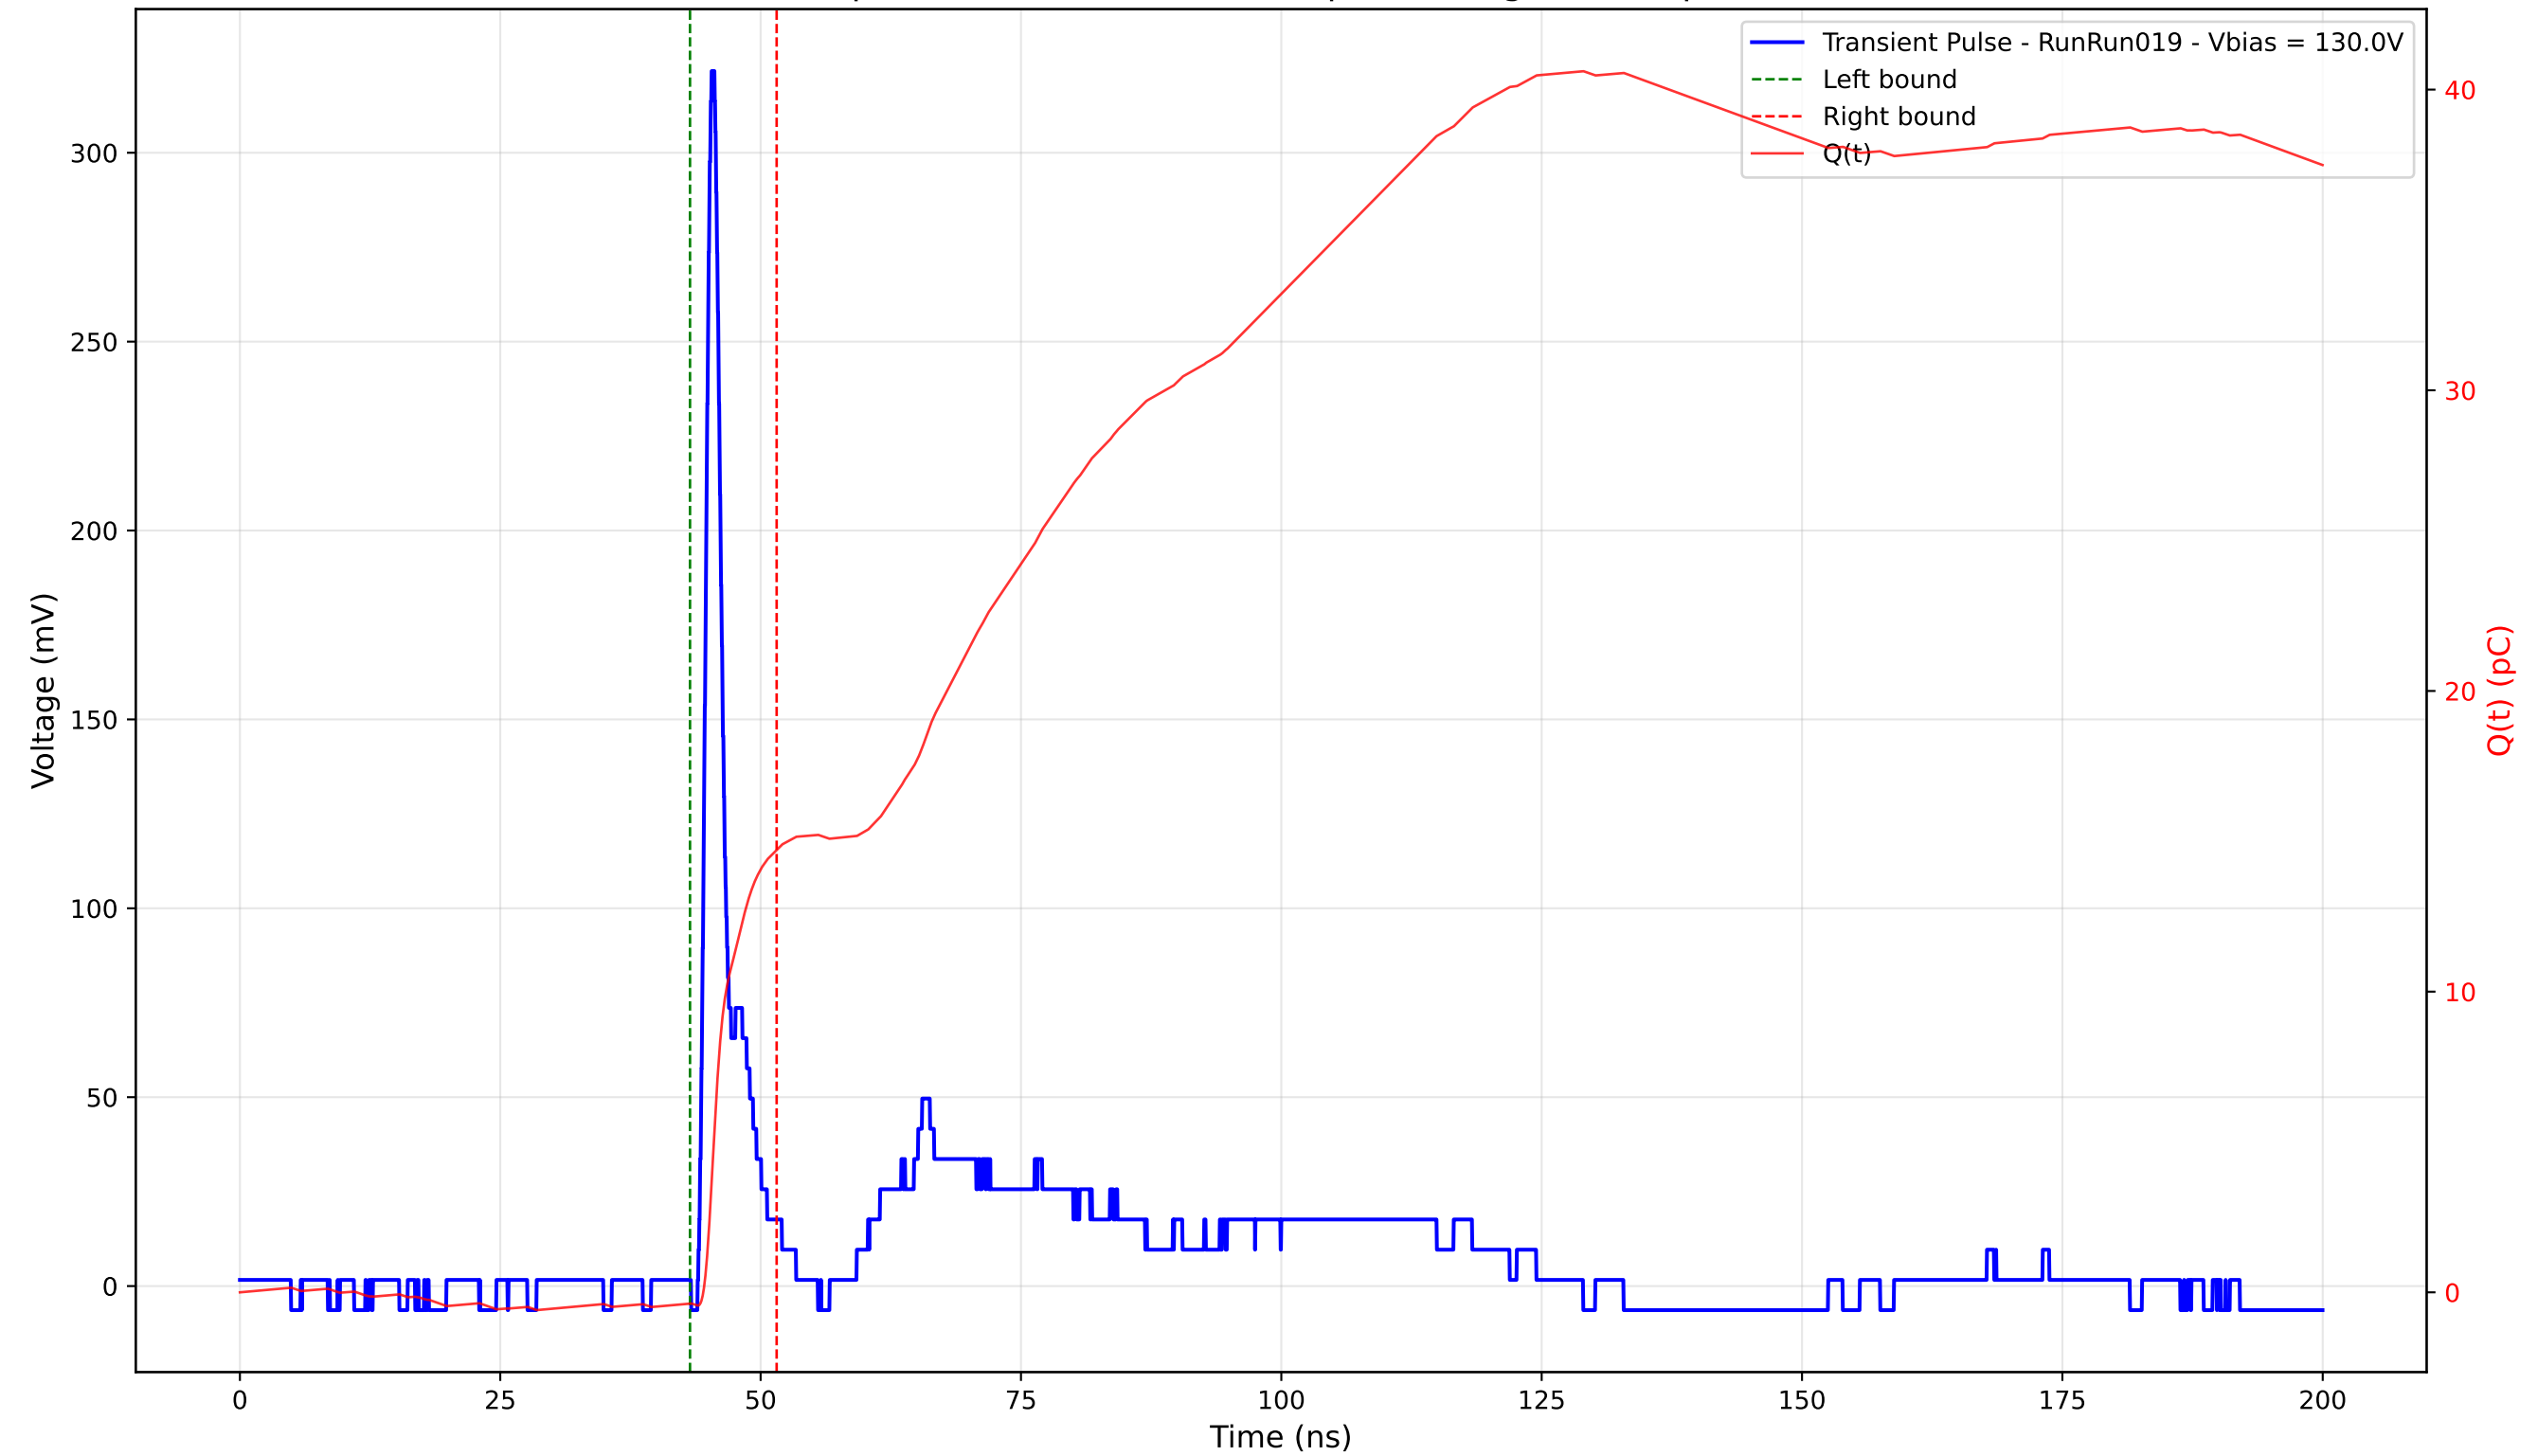


Transient Pulse - Sample: 4003 - Position: 115.0 μm - Charge: 17.53 pC - Rise Time: 0.91 ns

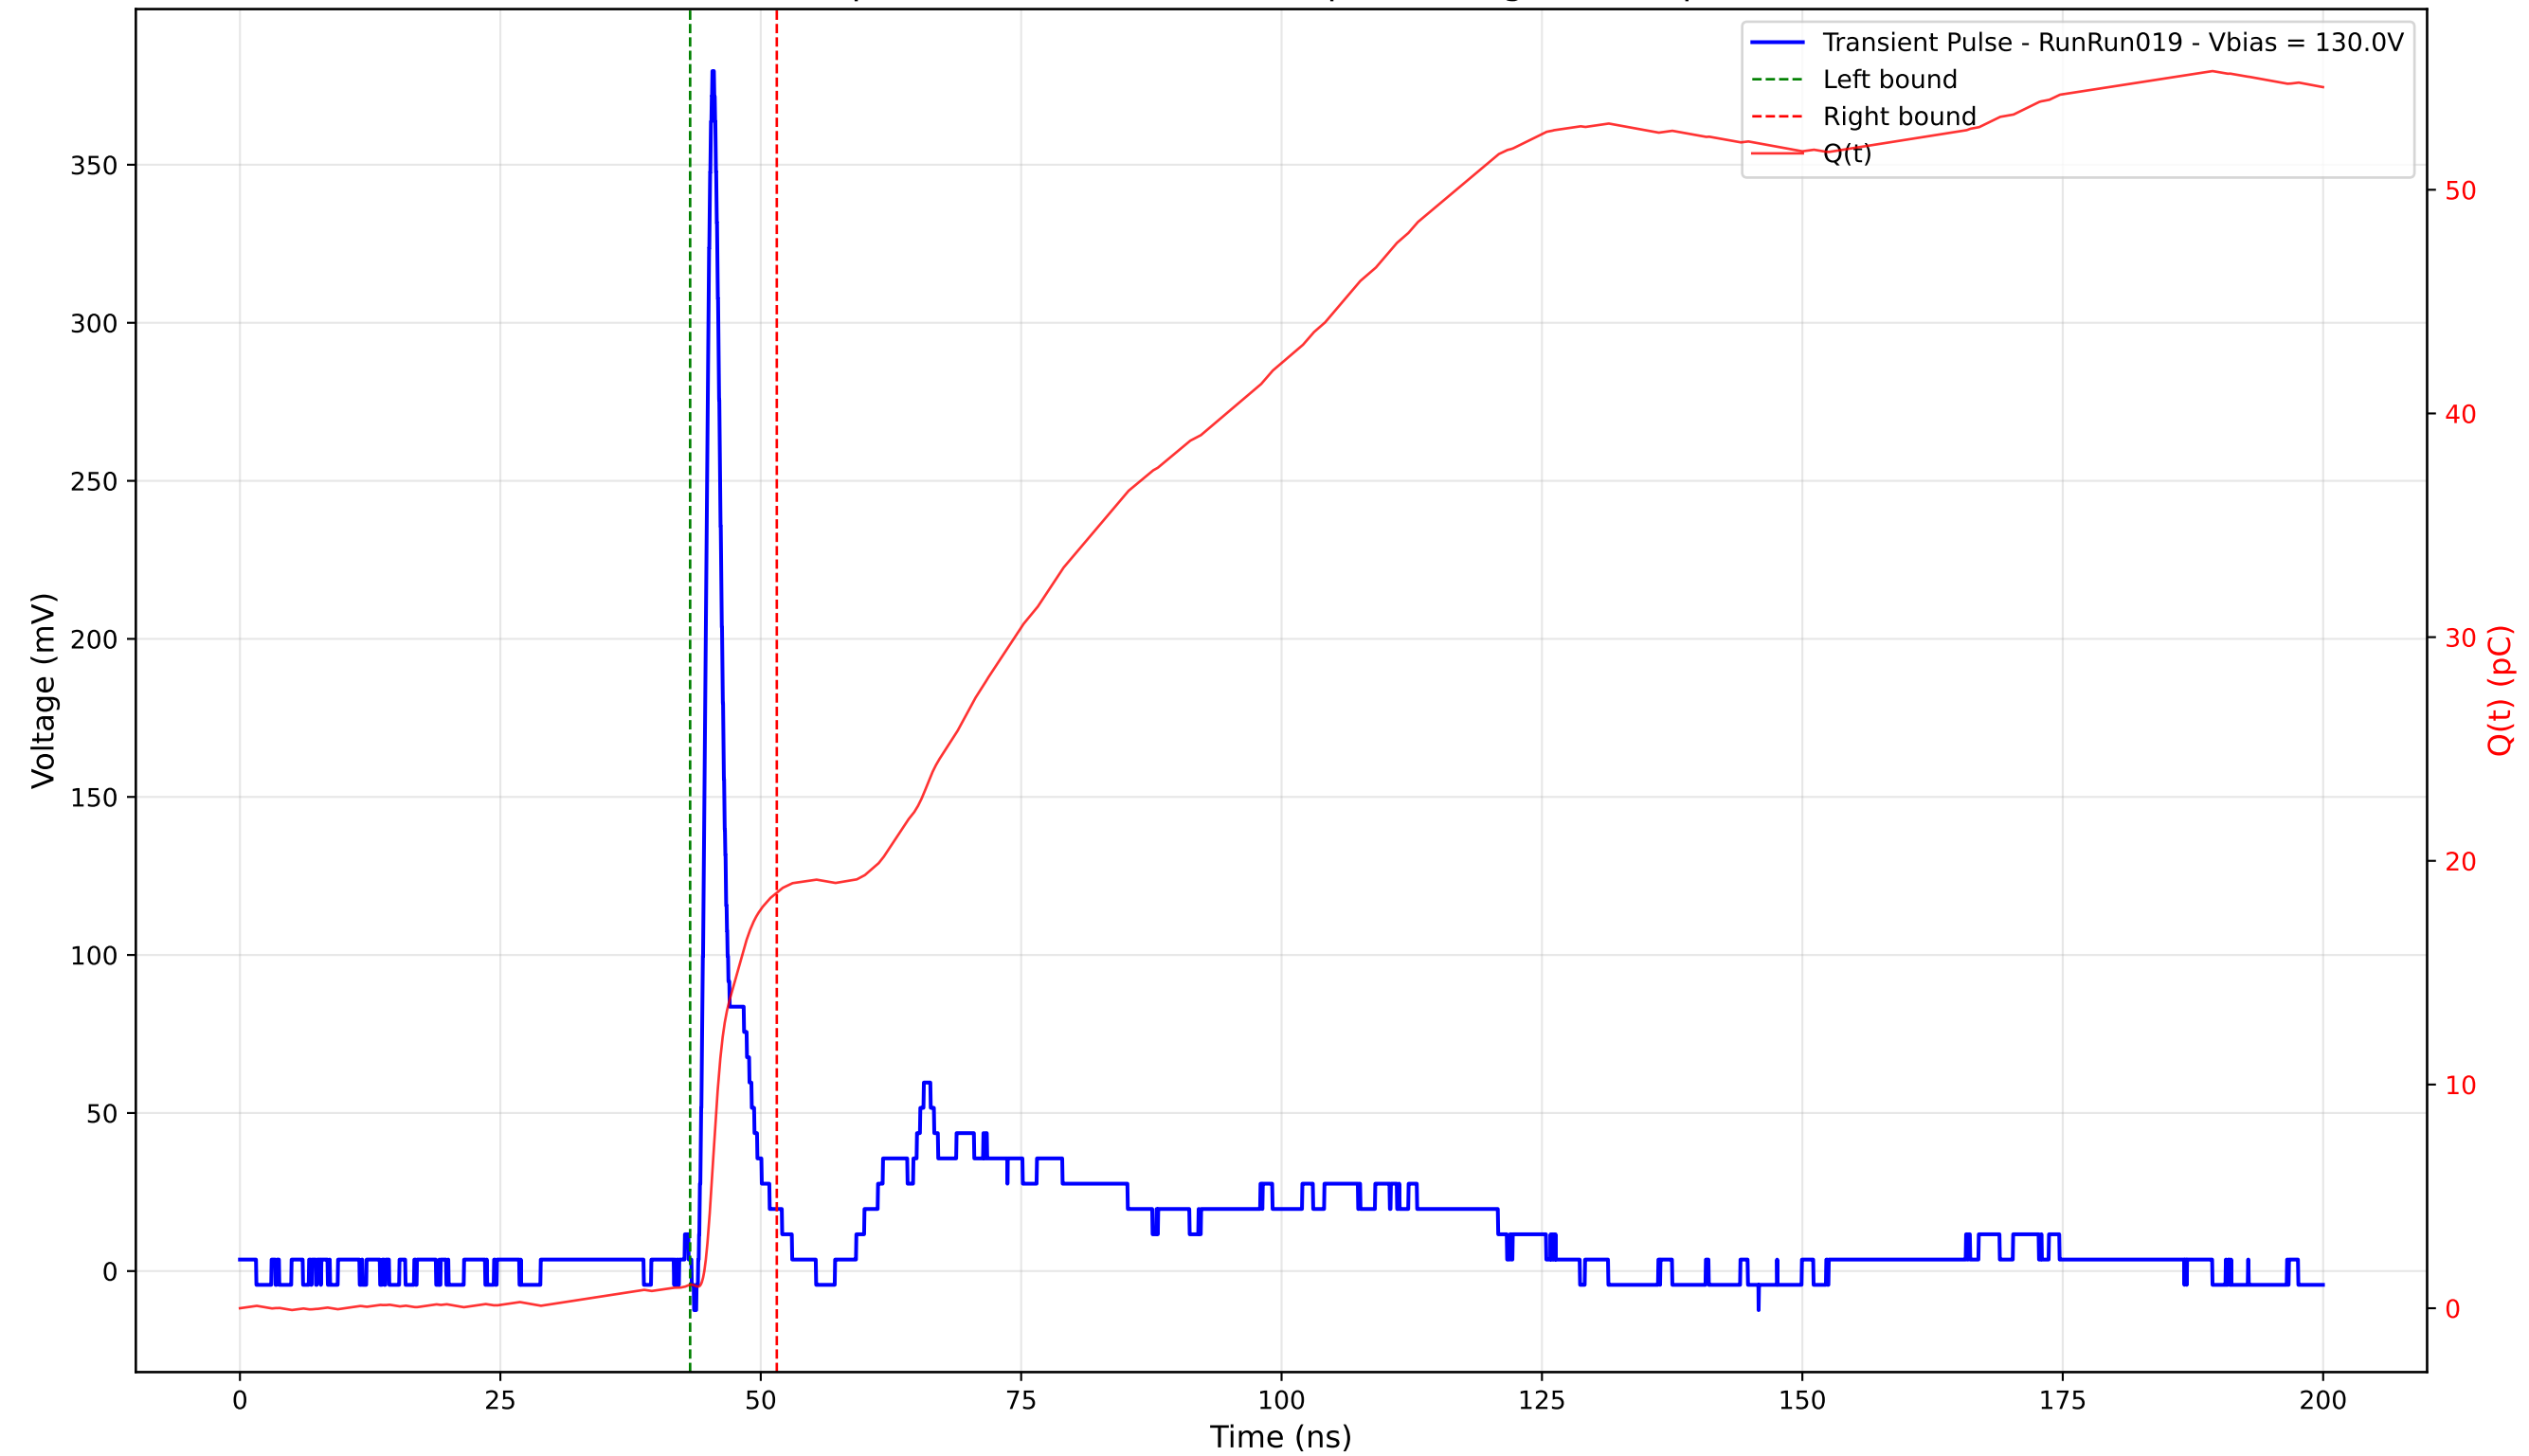


Transient Pulse - Sample: 4003 - Position: 120.0 μm - Charge: 18.45 pC - Rise Time: 0.90 ns

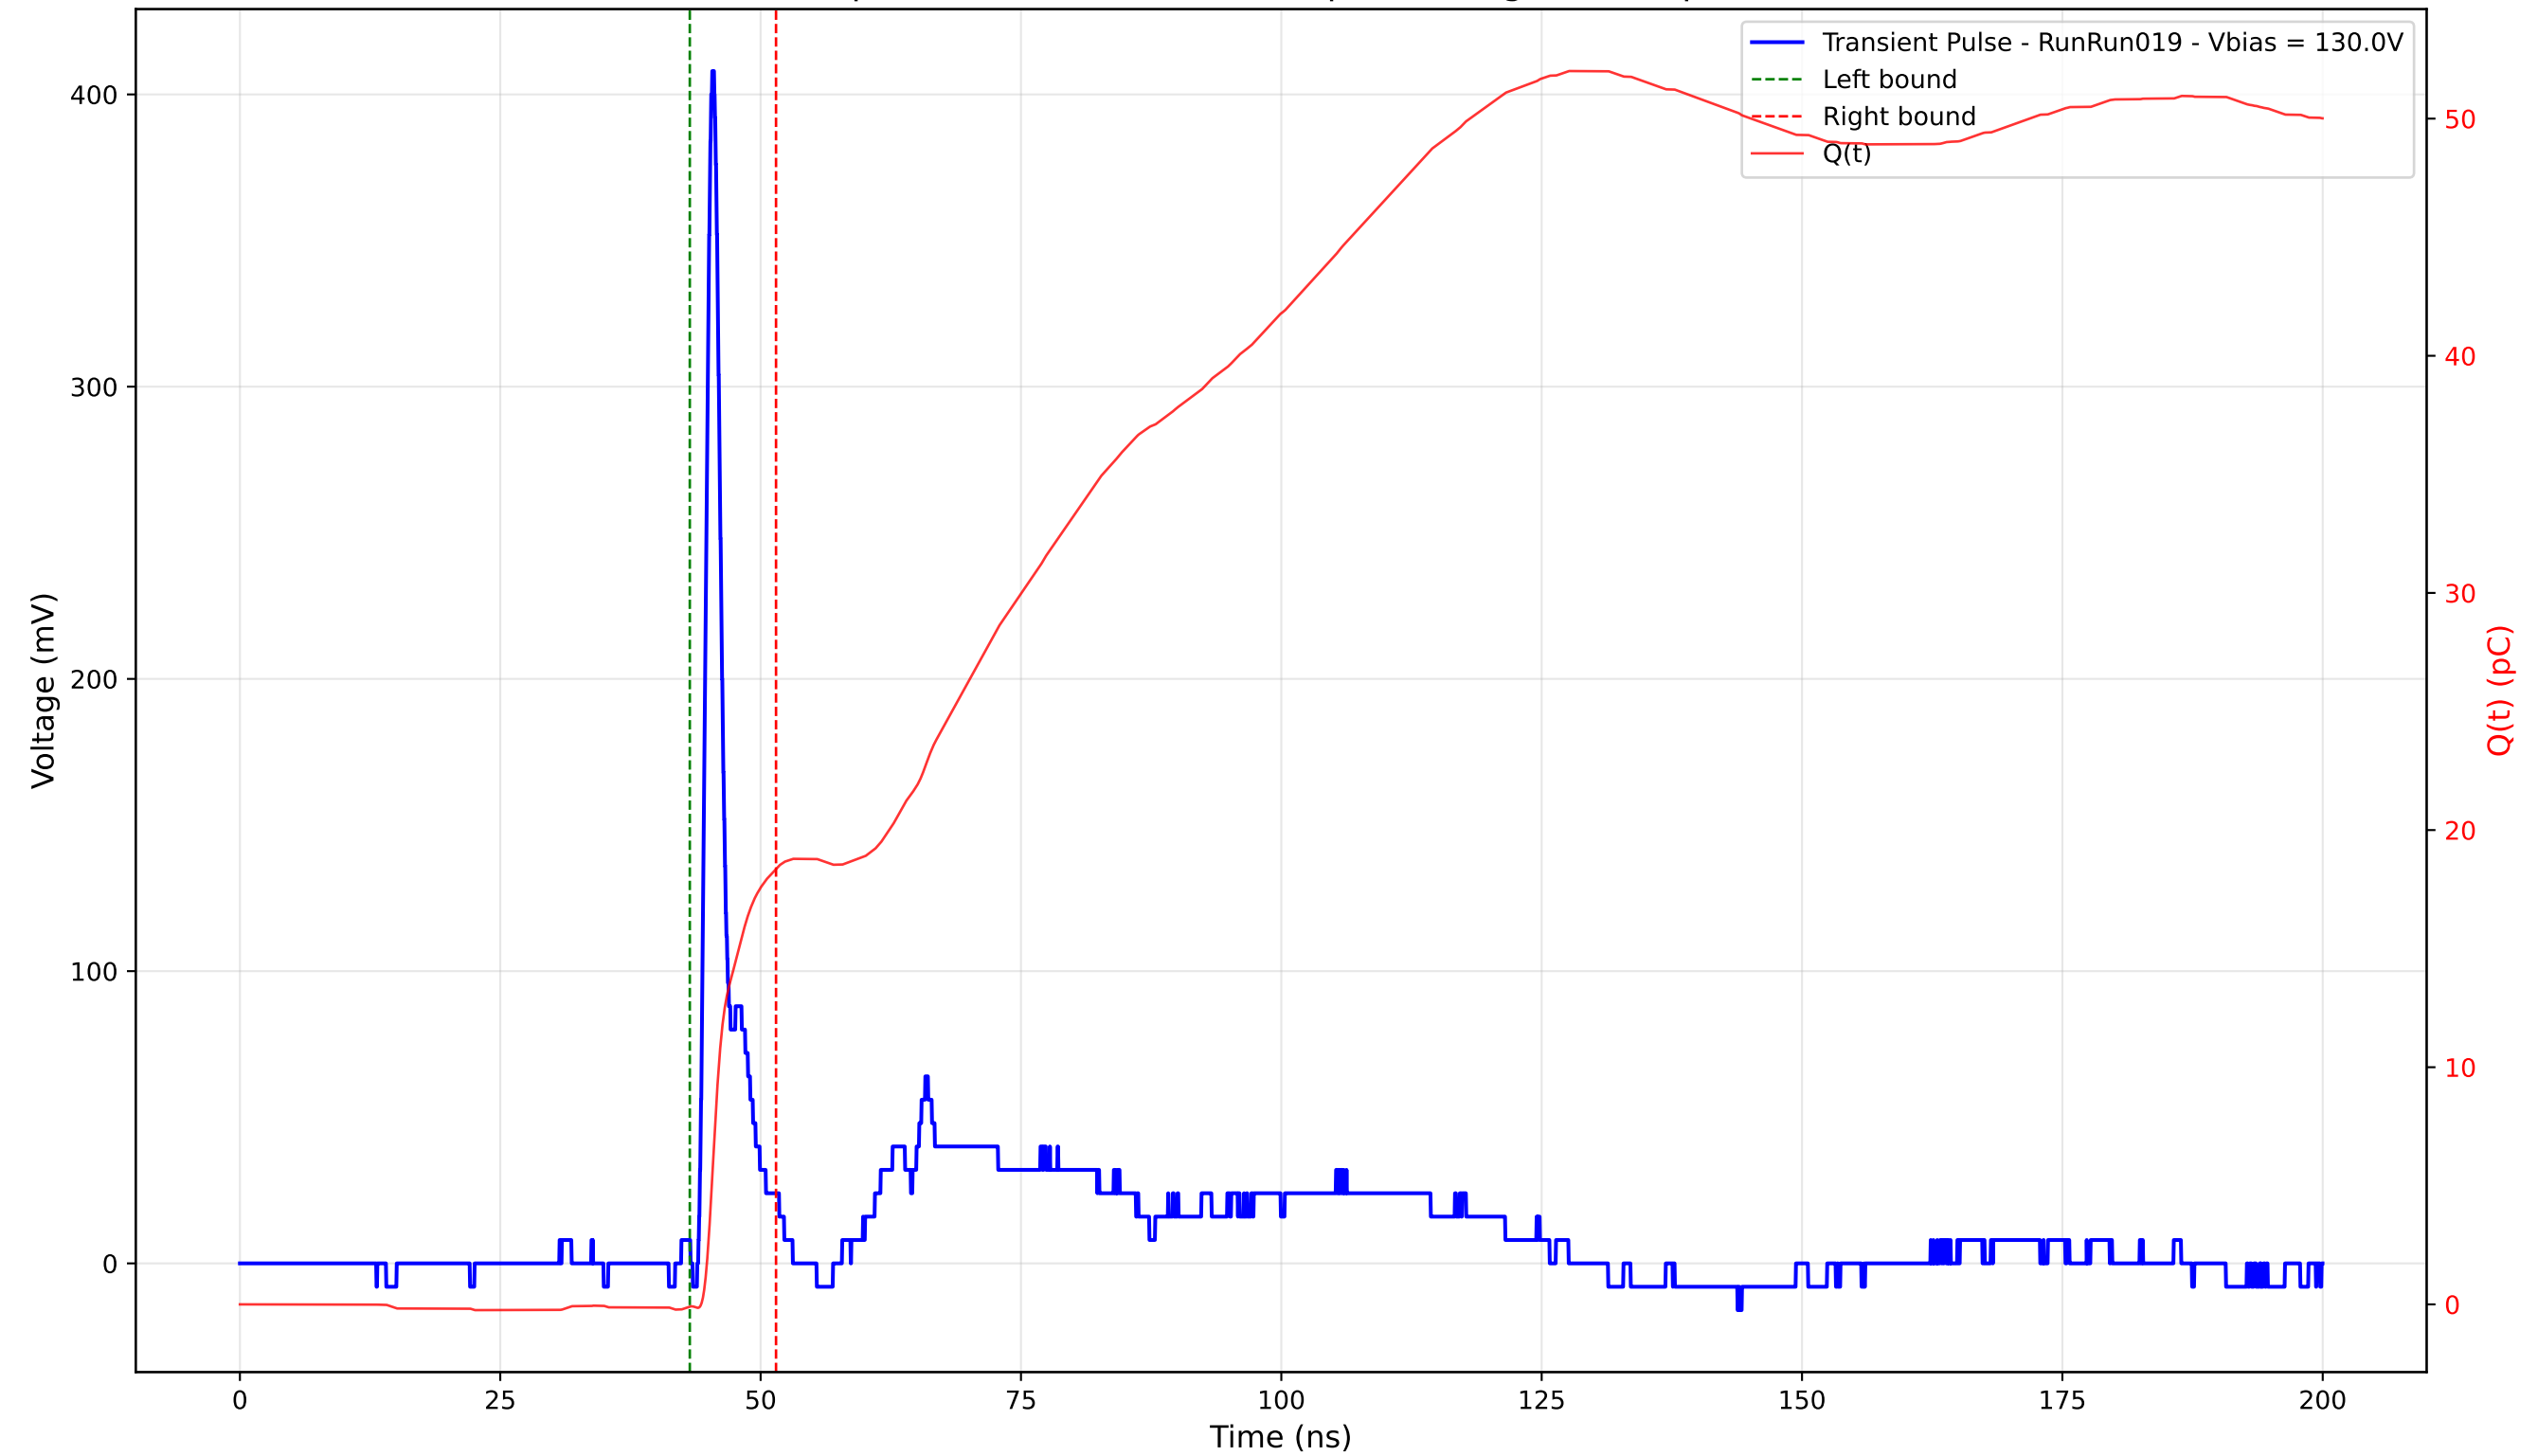


Transient Pulse - Sample: 4003 - Position: 125.0 μm - Charge: 19.42 pC - Rise Time: 0.90 ns

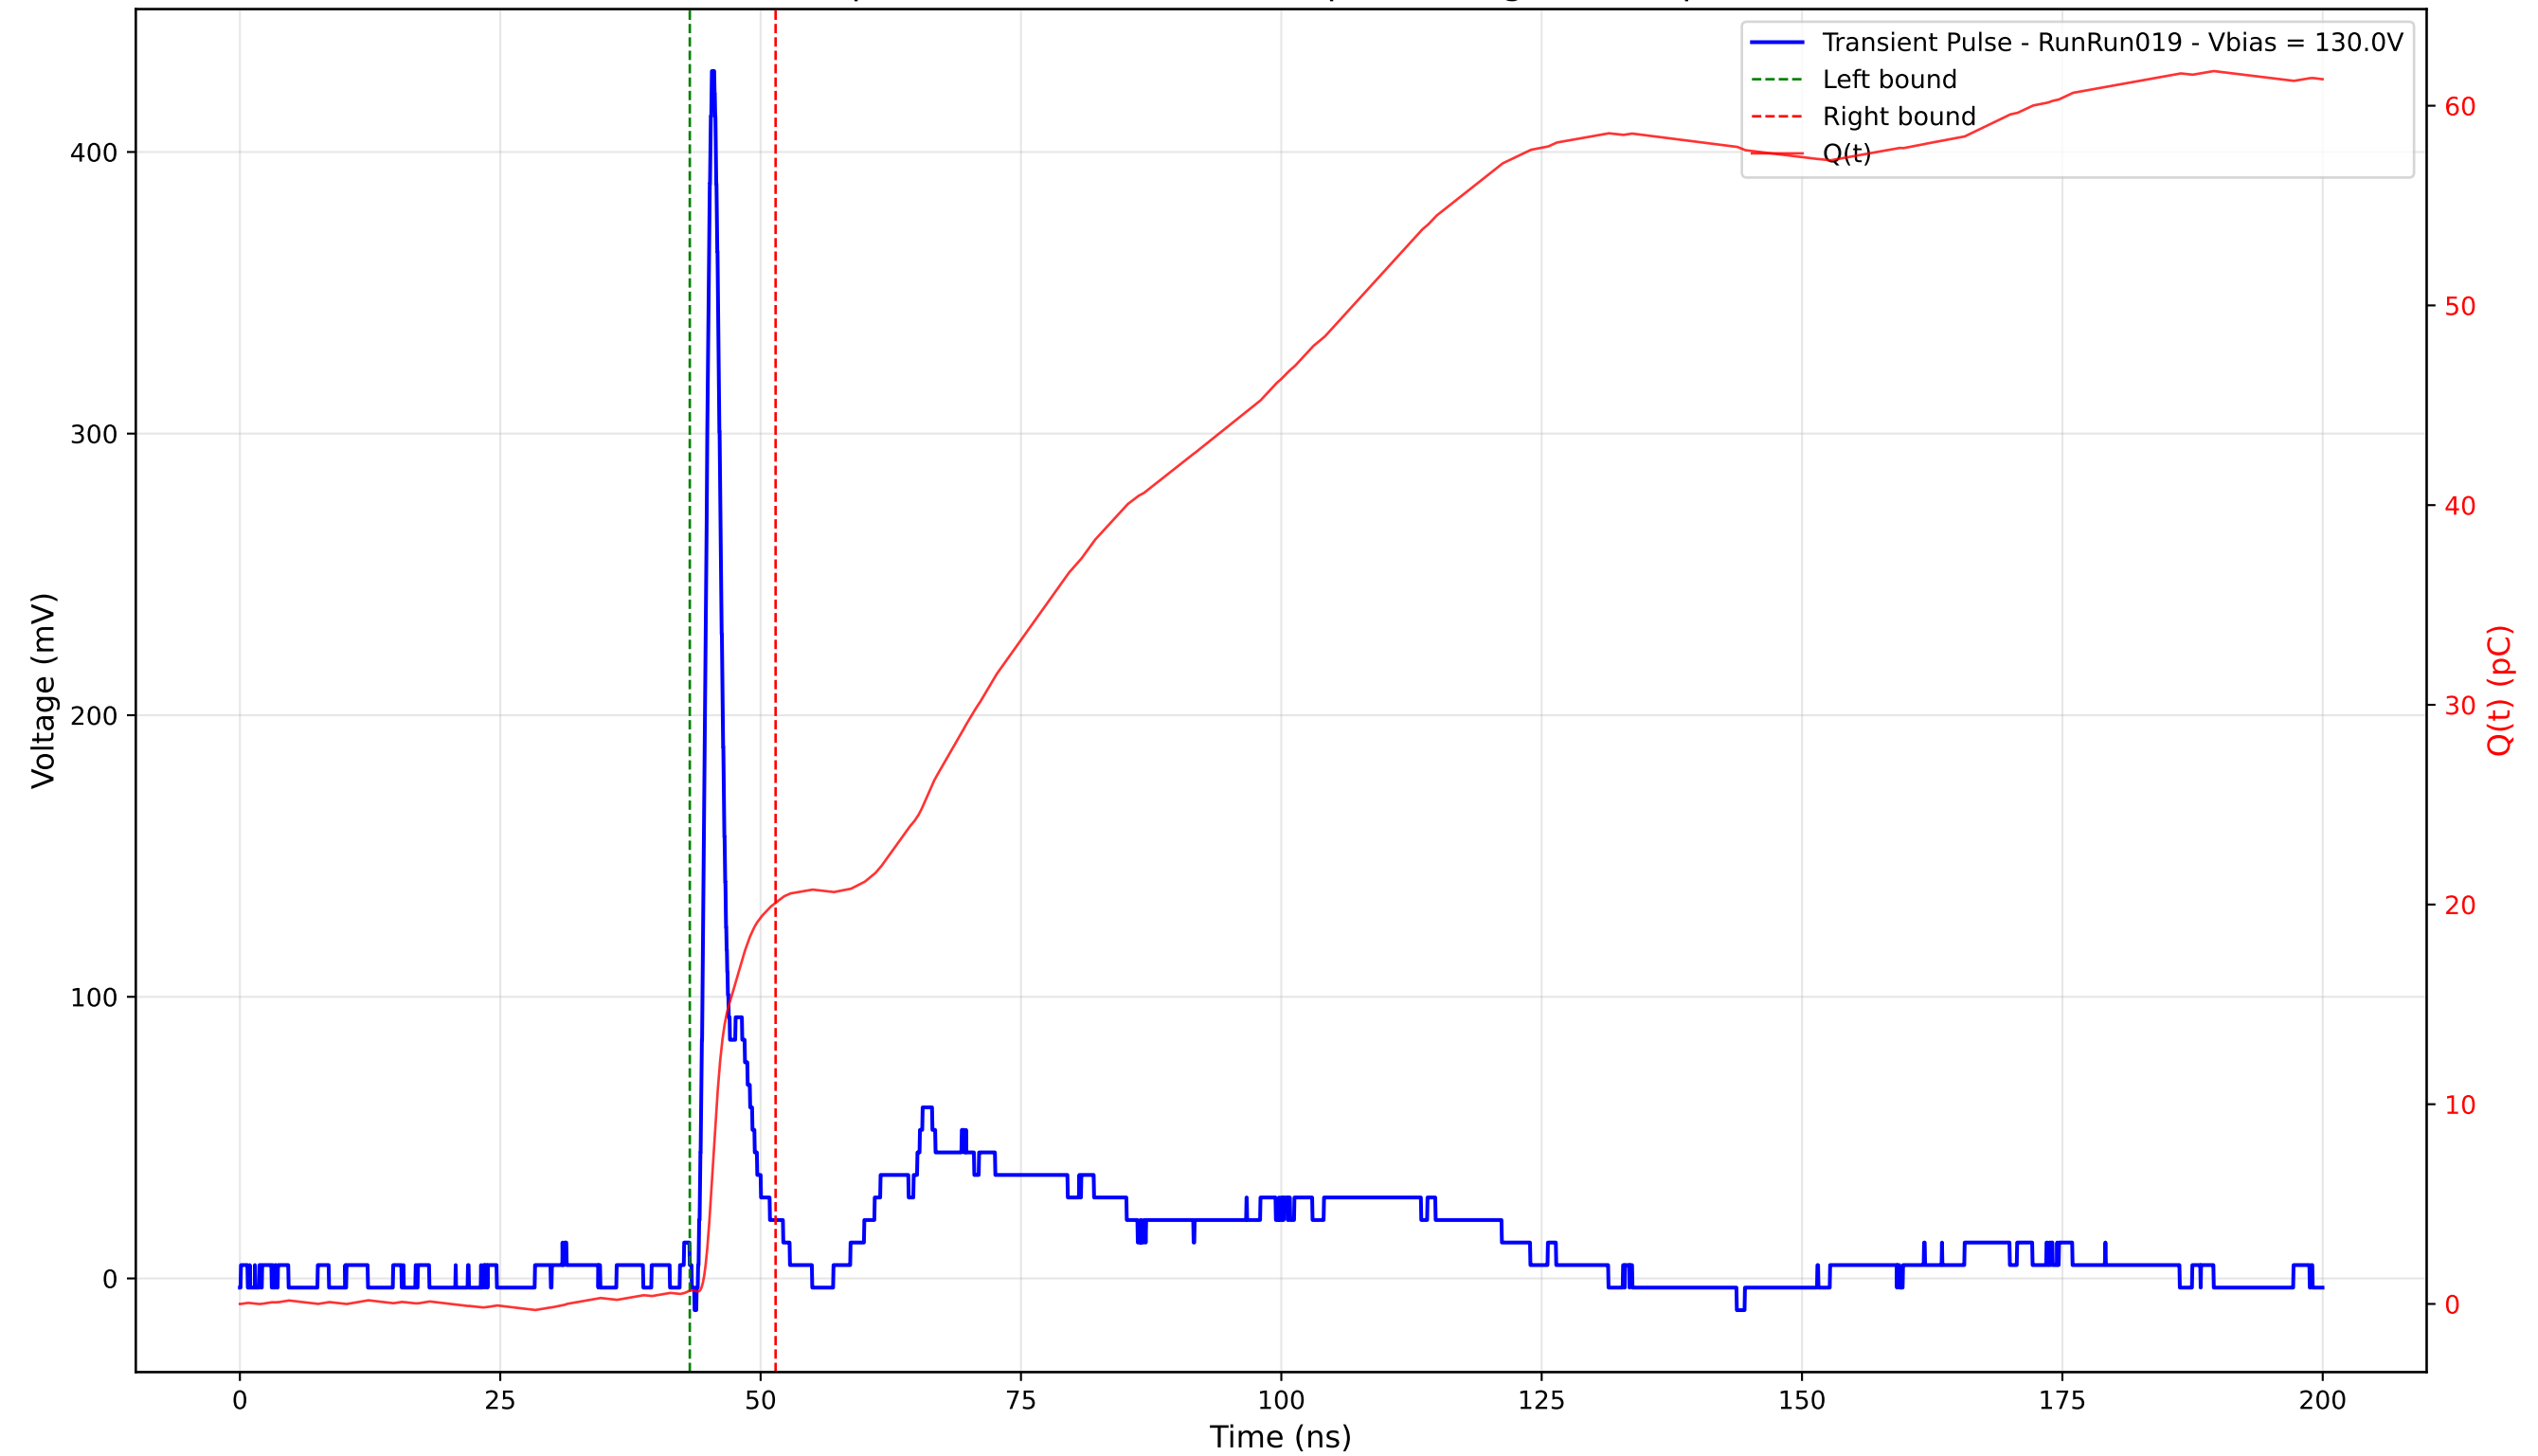


Transient Pulse - Sample: 4003 - Position: 130.0 μm - Charge: 19.58 pC - Rise Time: 0.92 ns

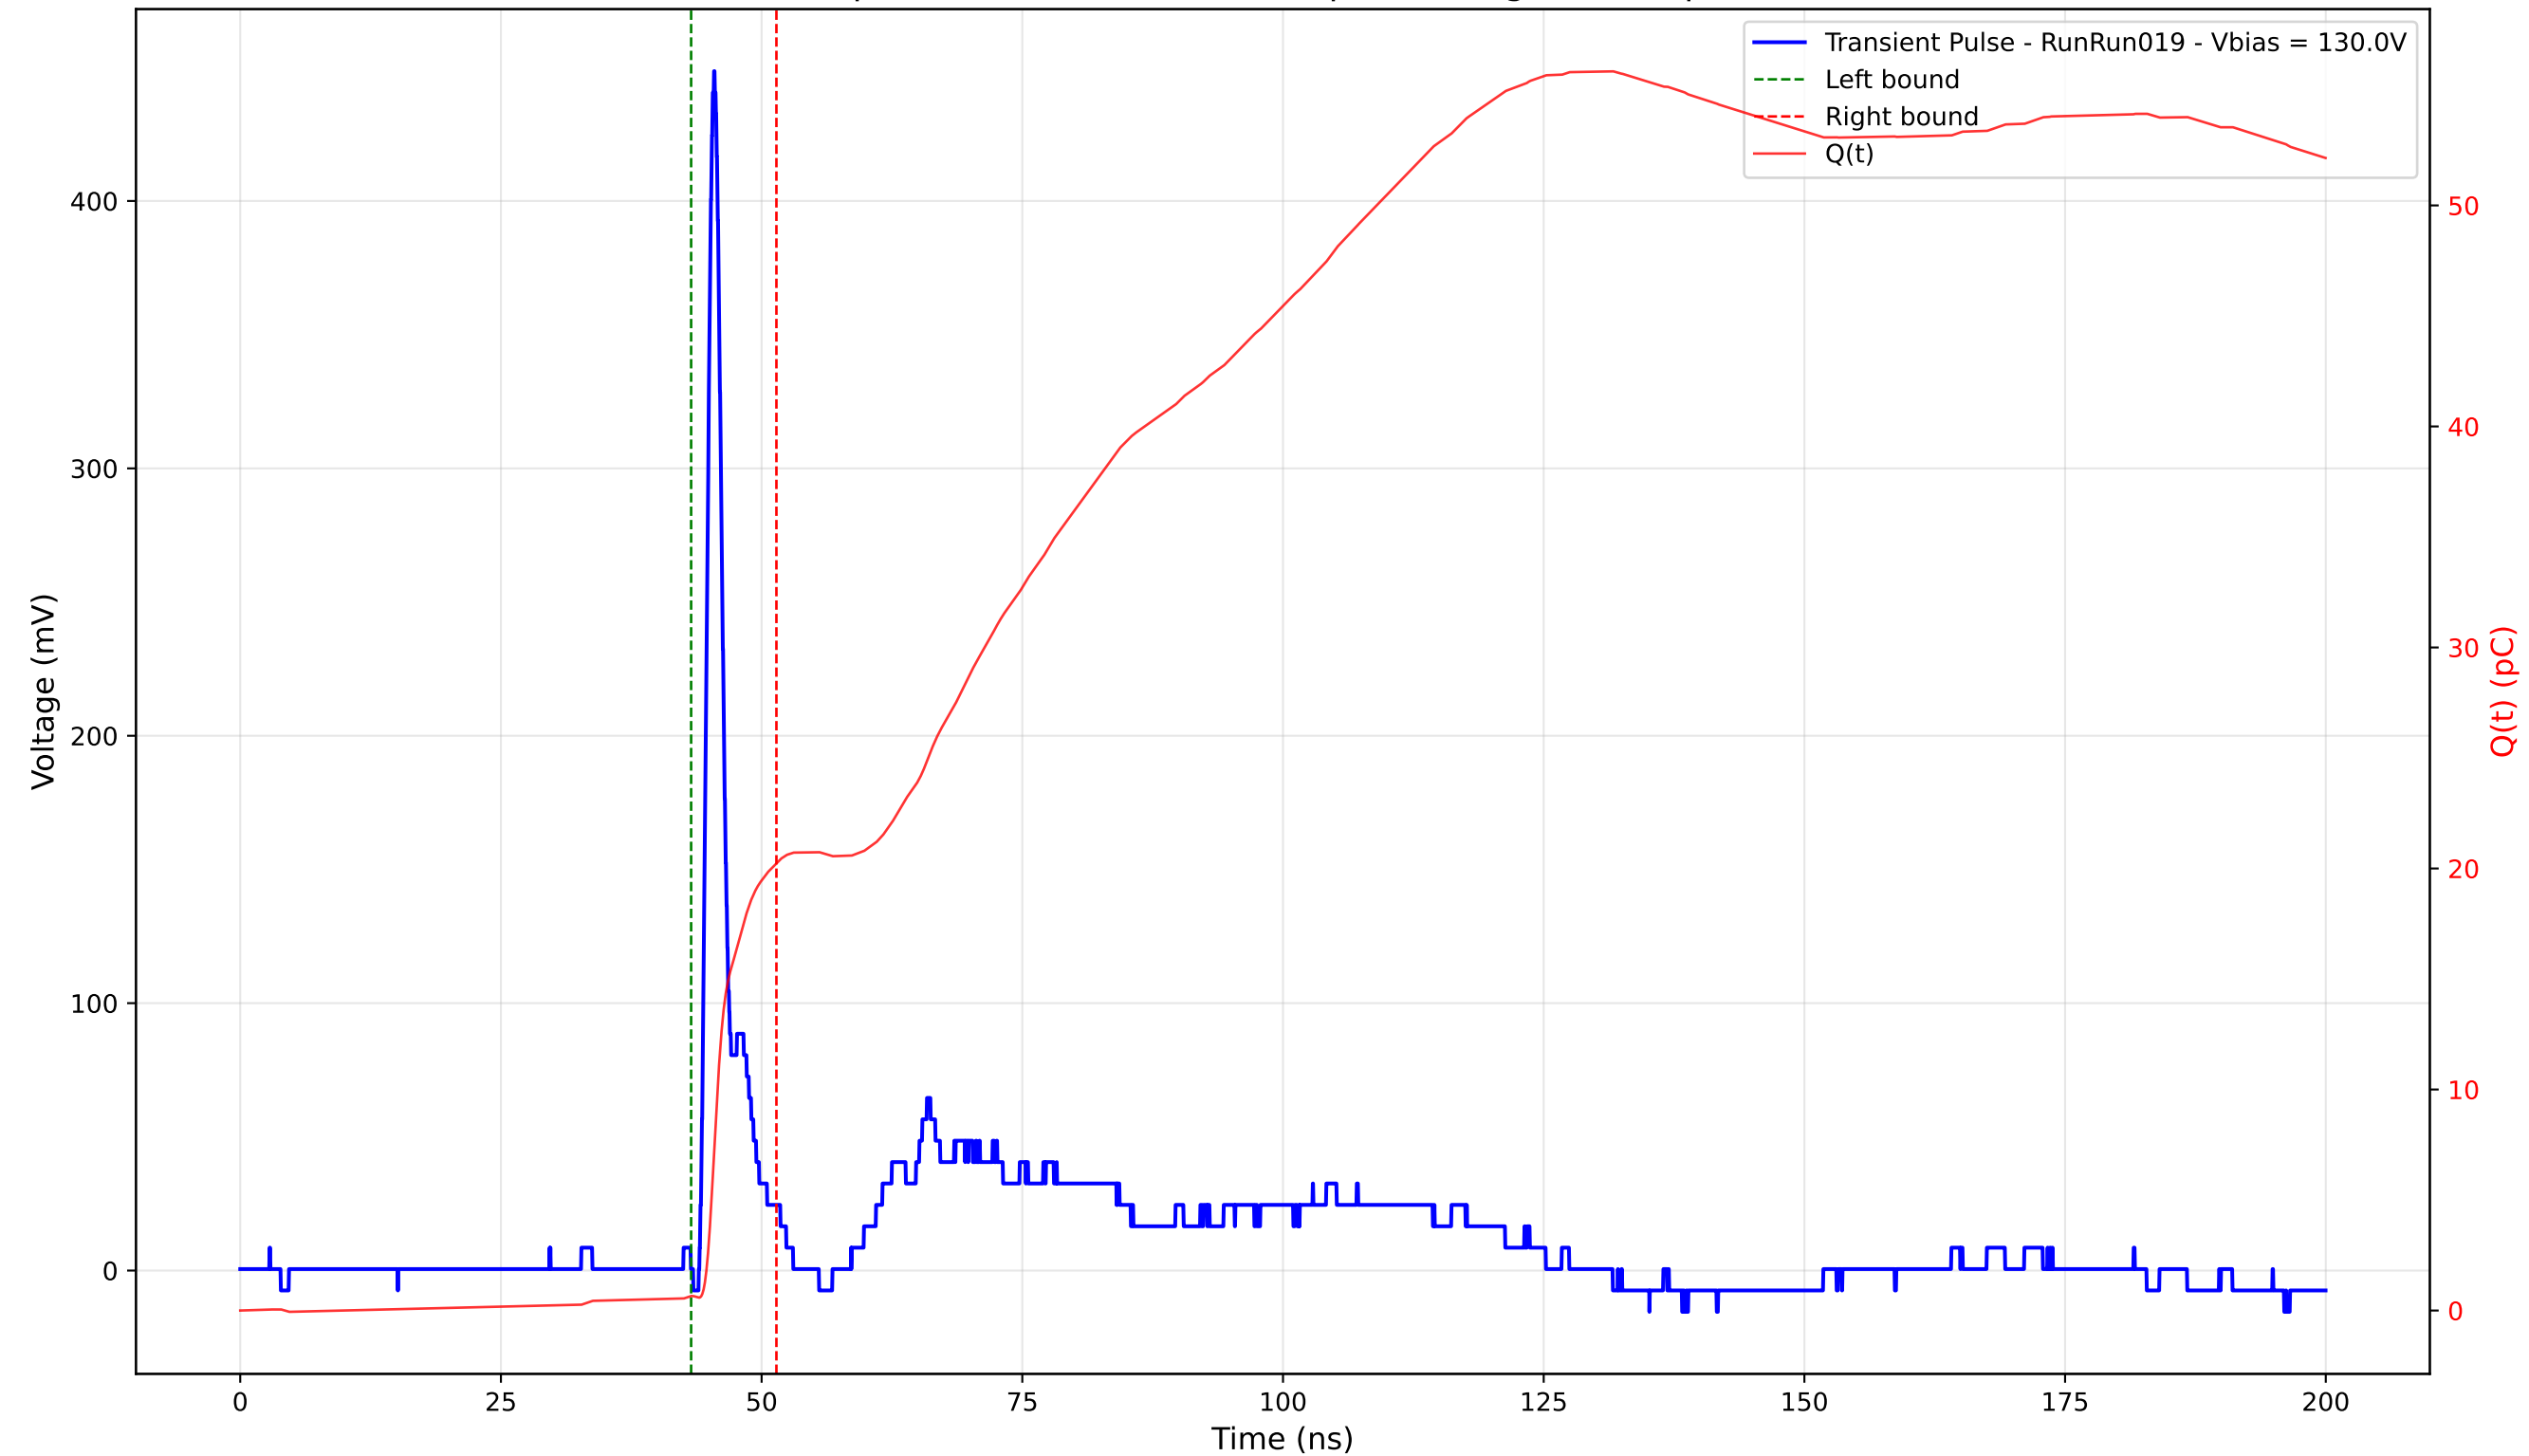


Transient Pulse - Sample: 4003 - Position: 135.0 μm - Charge: 19.74 pC - Rise Time: 0.91 ns

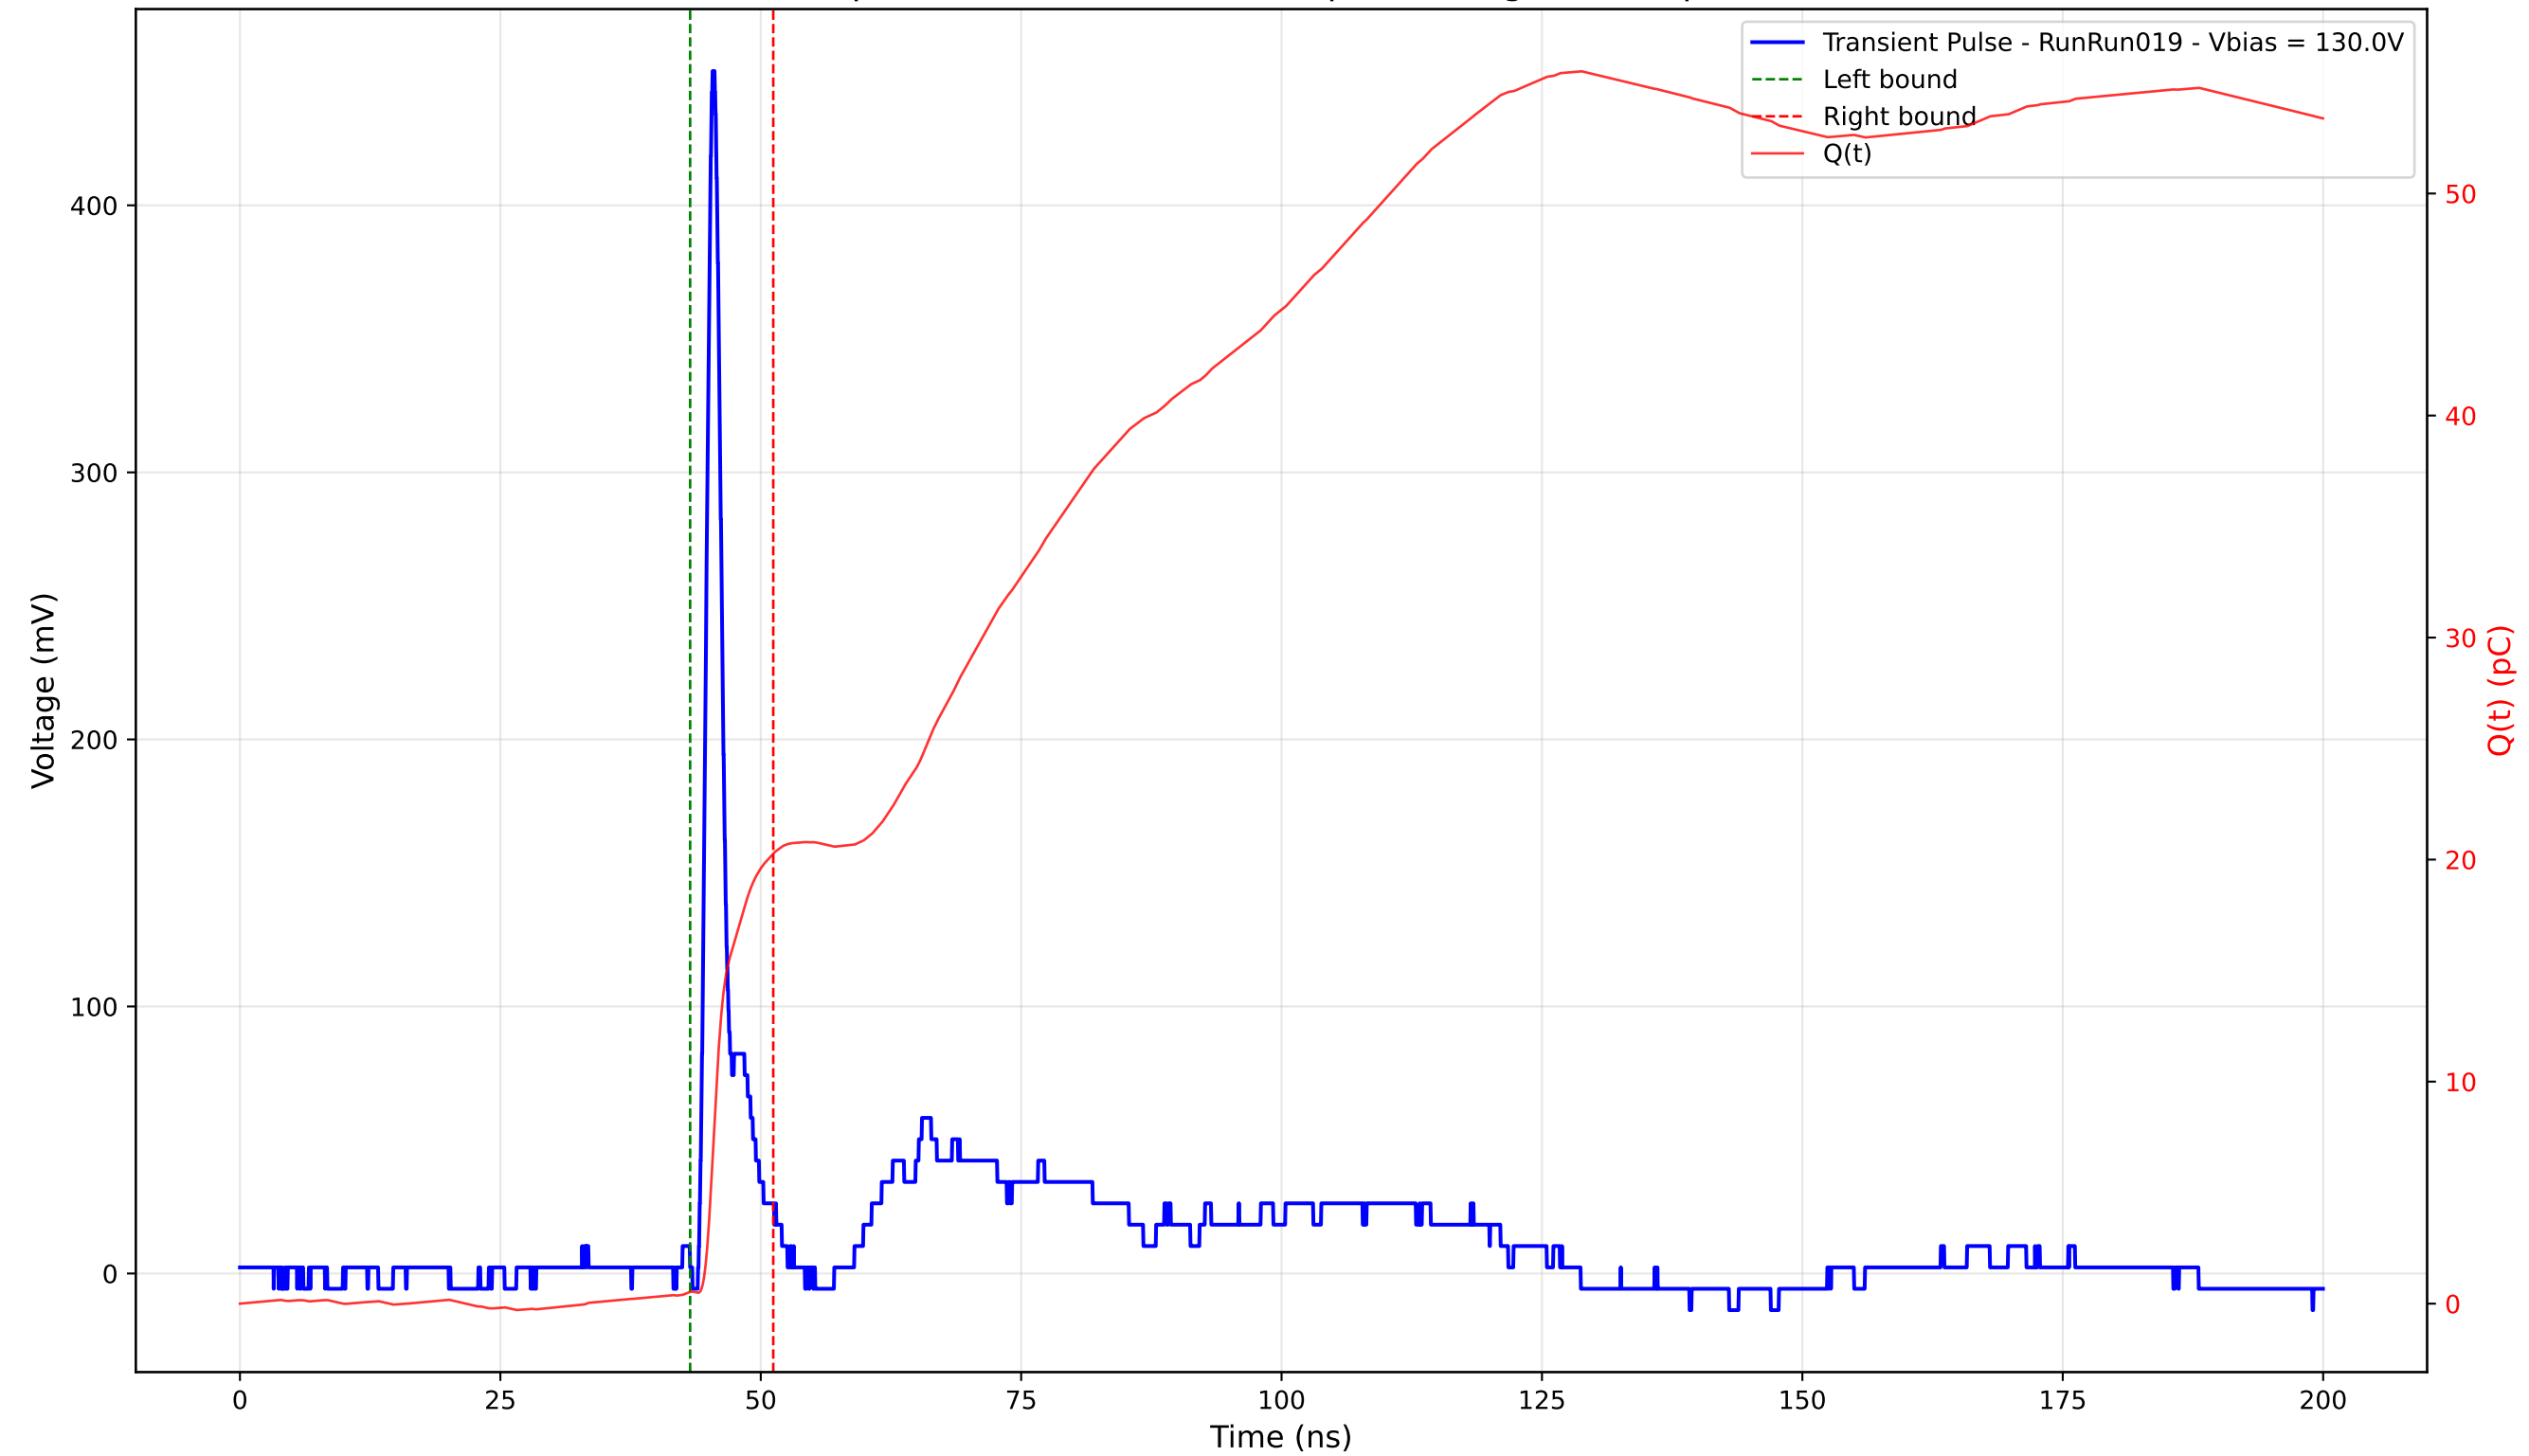


Transient Pulse - Sample: 4003 - Position: 140.0 μm - Charge: 19.91 pC - Rise Time: 0.94 ns

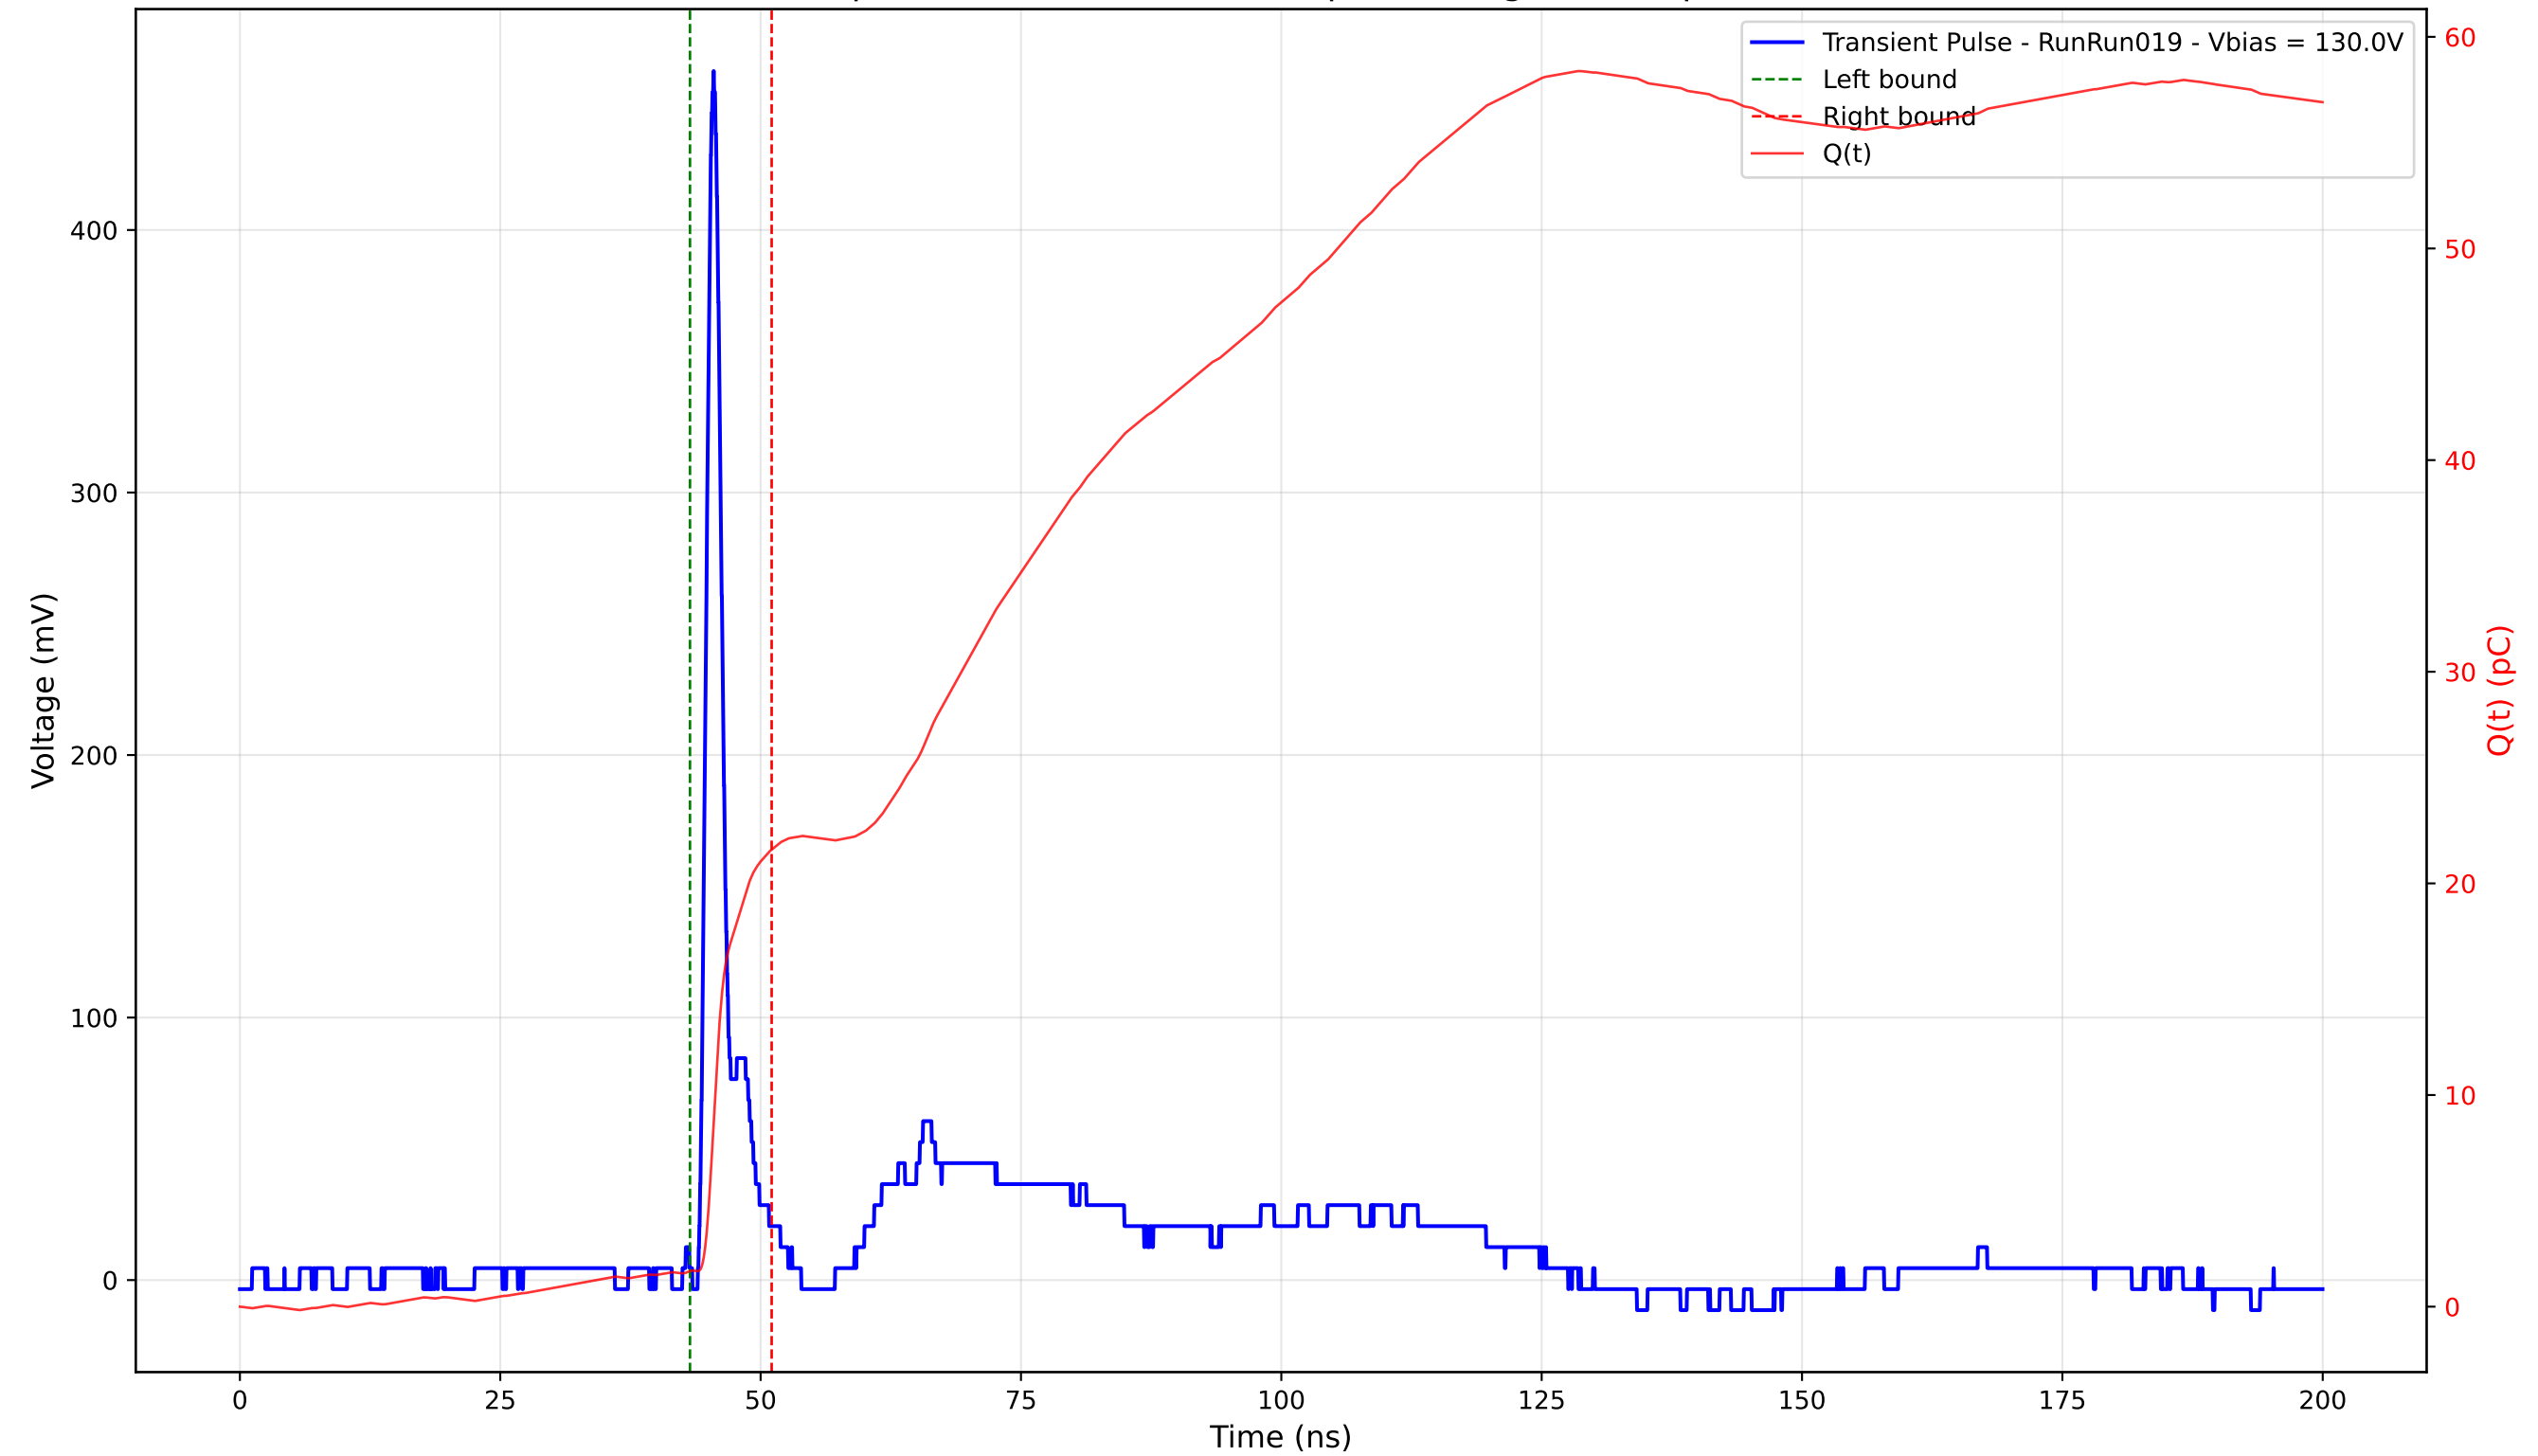


Transient Pulse - Sample: 4003 - Position: 145.0 μm - Charge: 19.42 pC - Rise Time: 0.95 ns

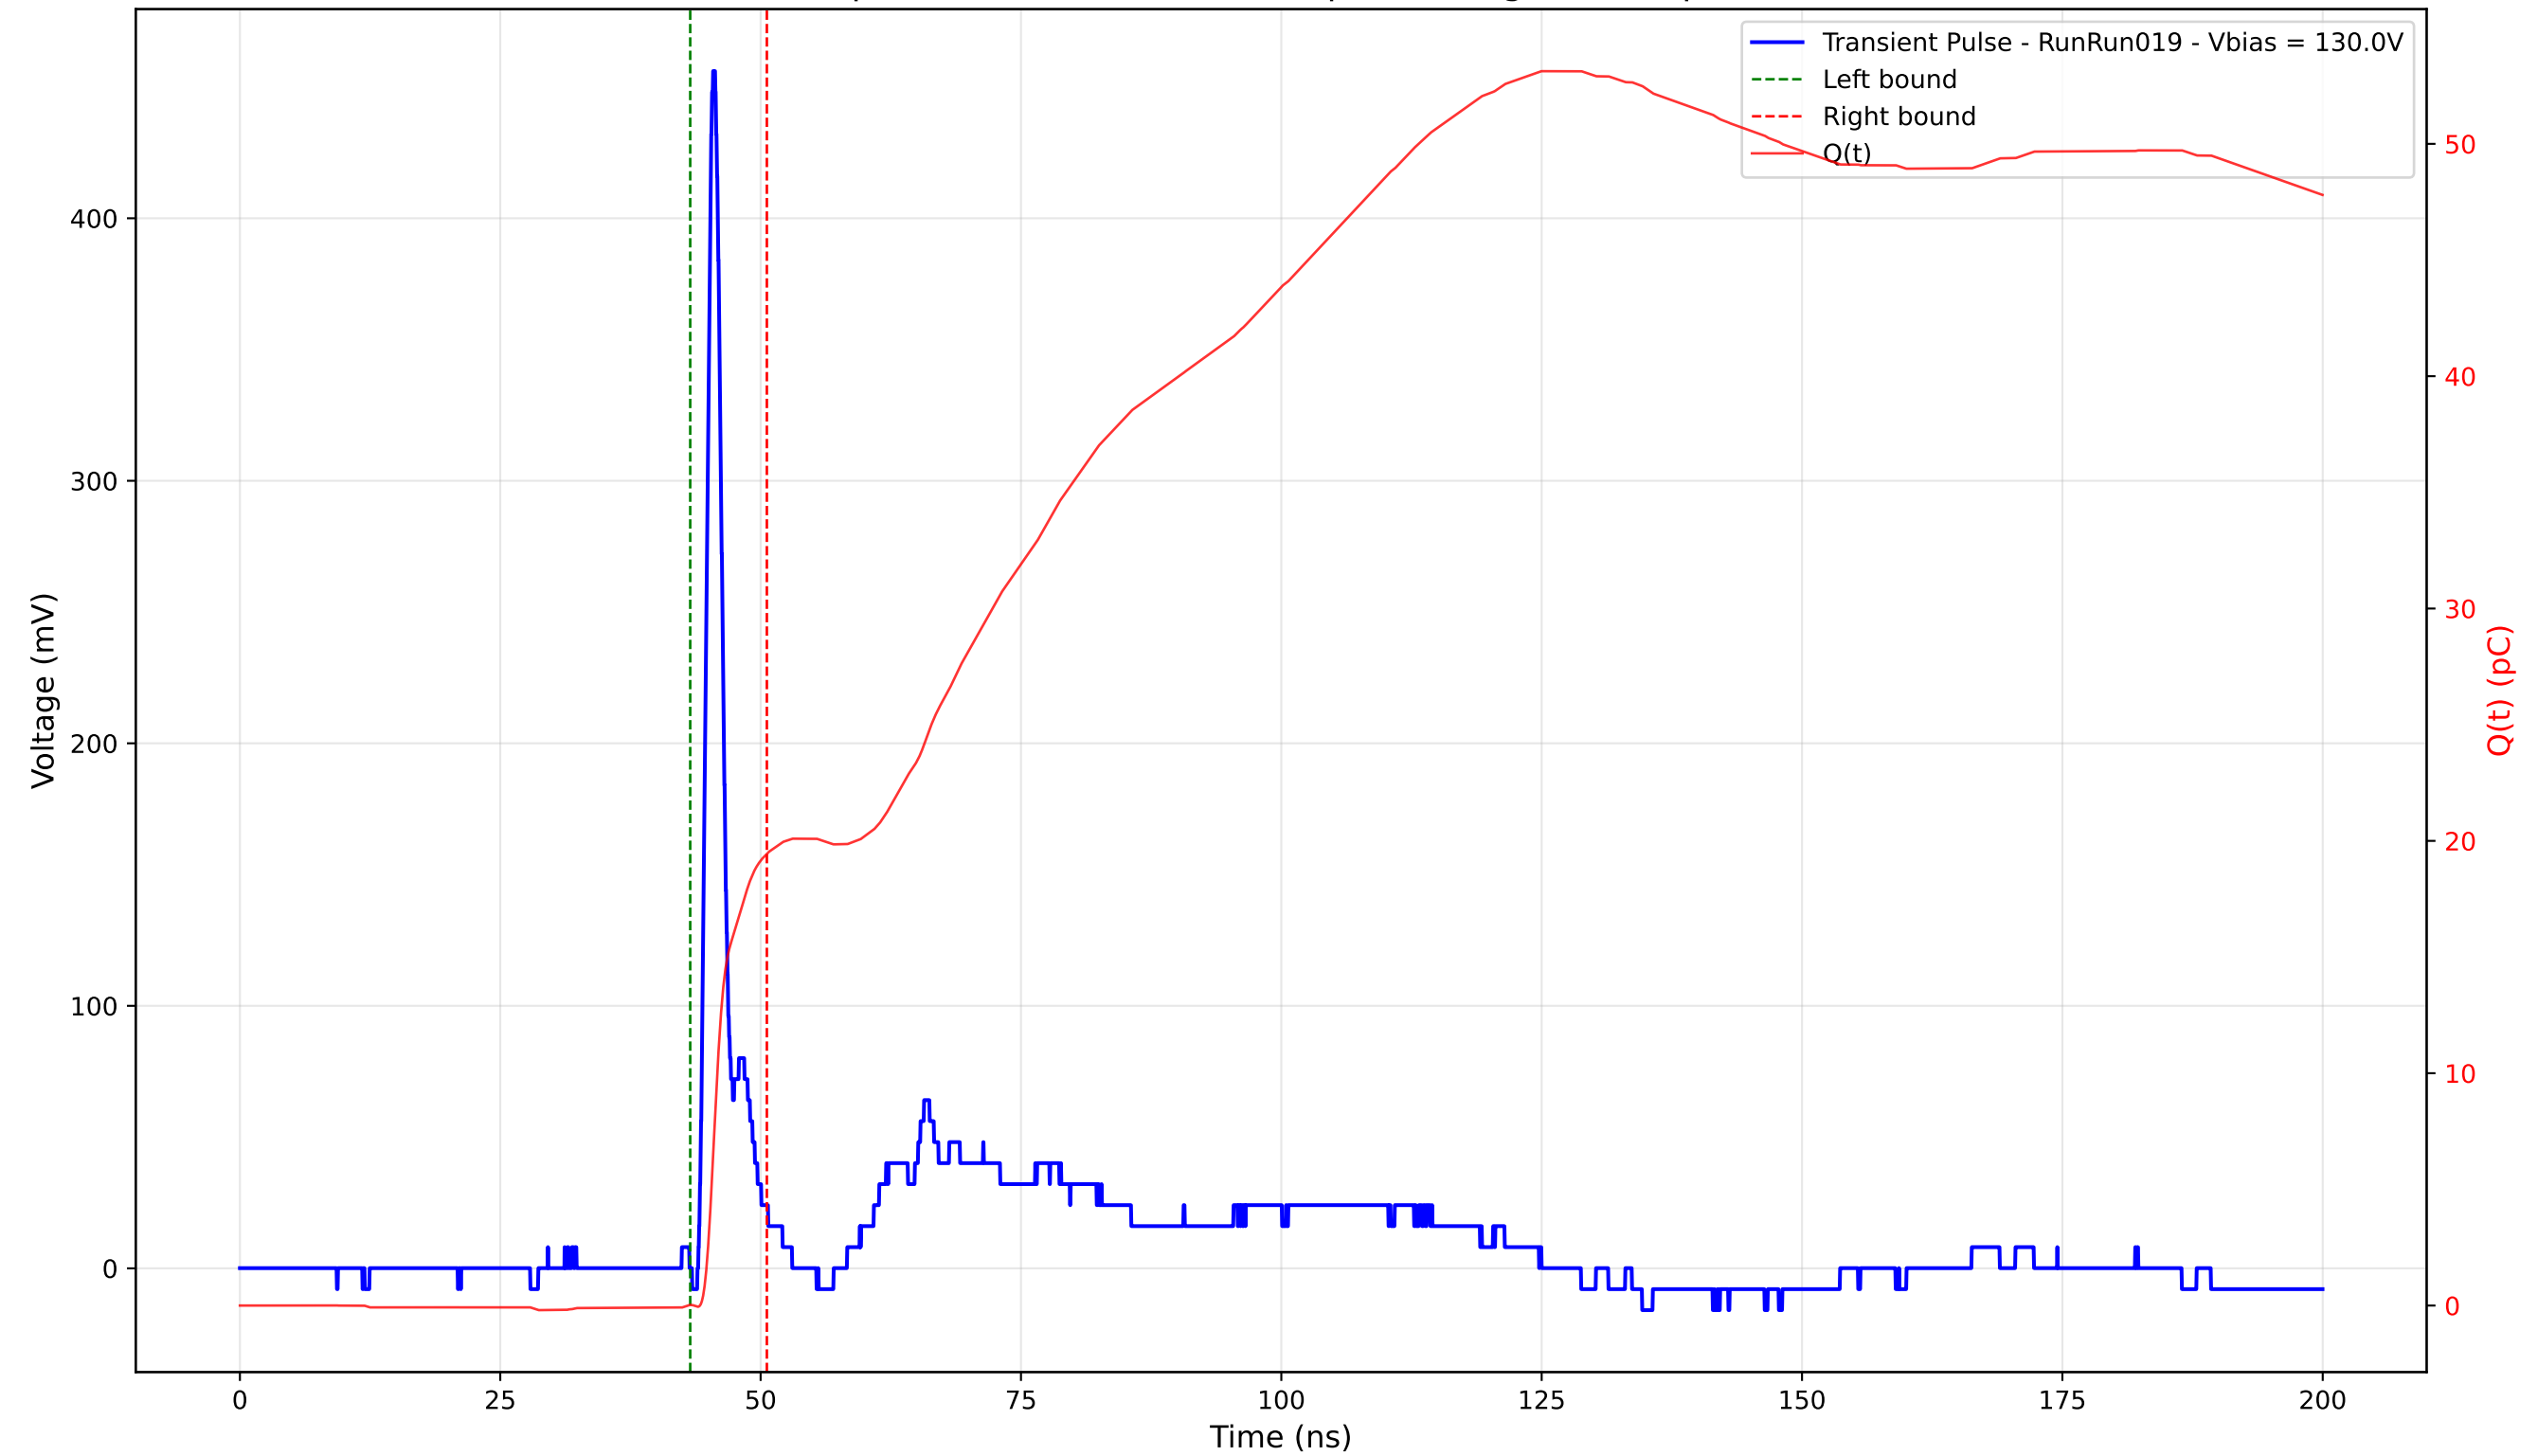


Transient Pulse - Sample: 4003 - Position: 150.0 μm - Charge: 19.70 pC - Rise Time: 0.94 ns

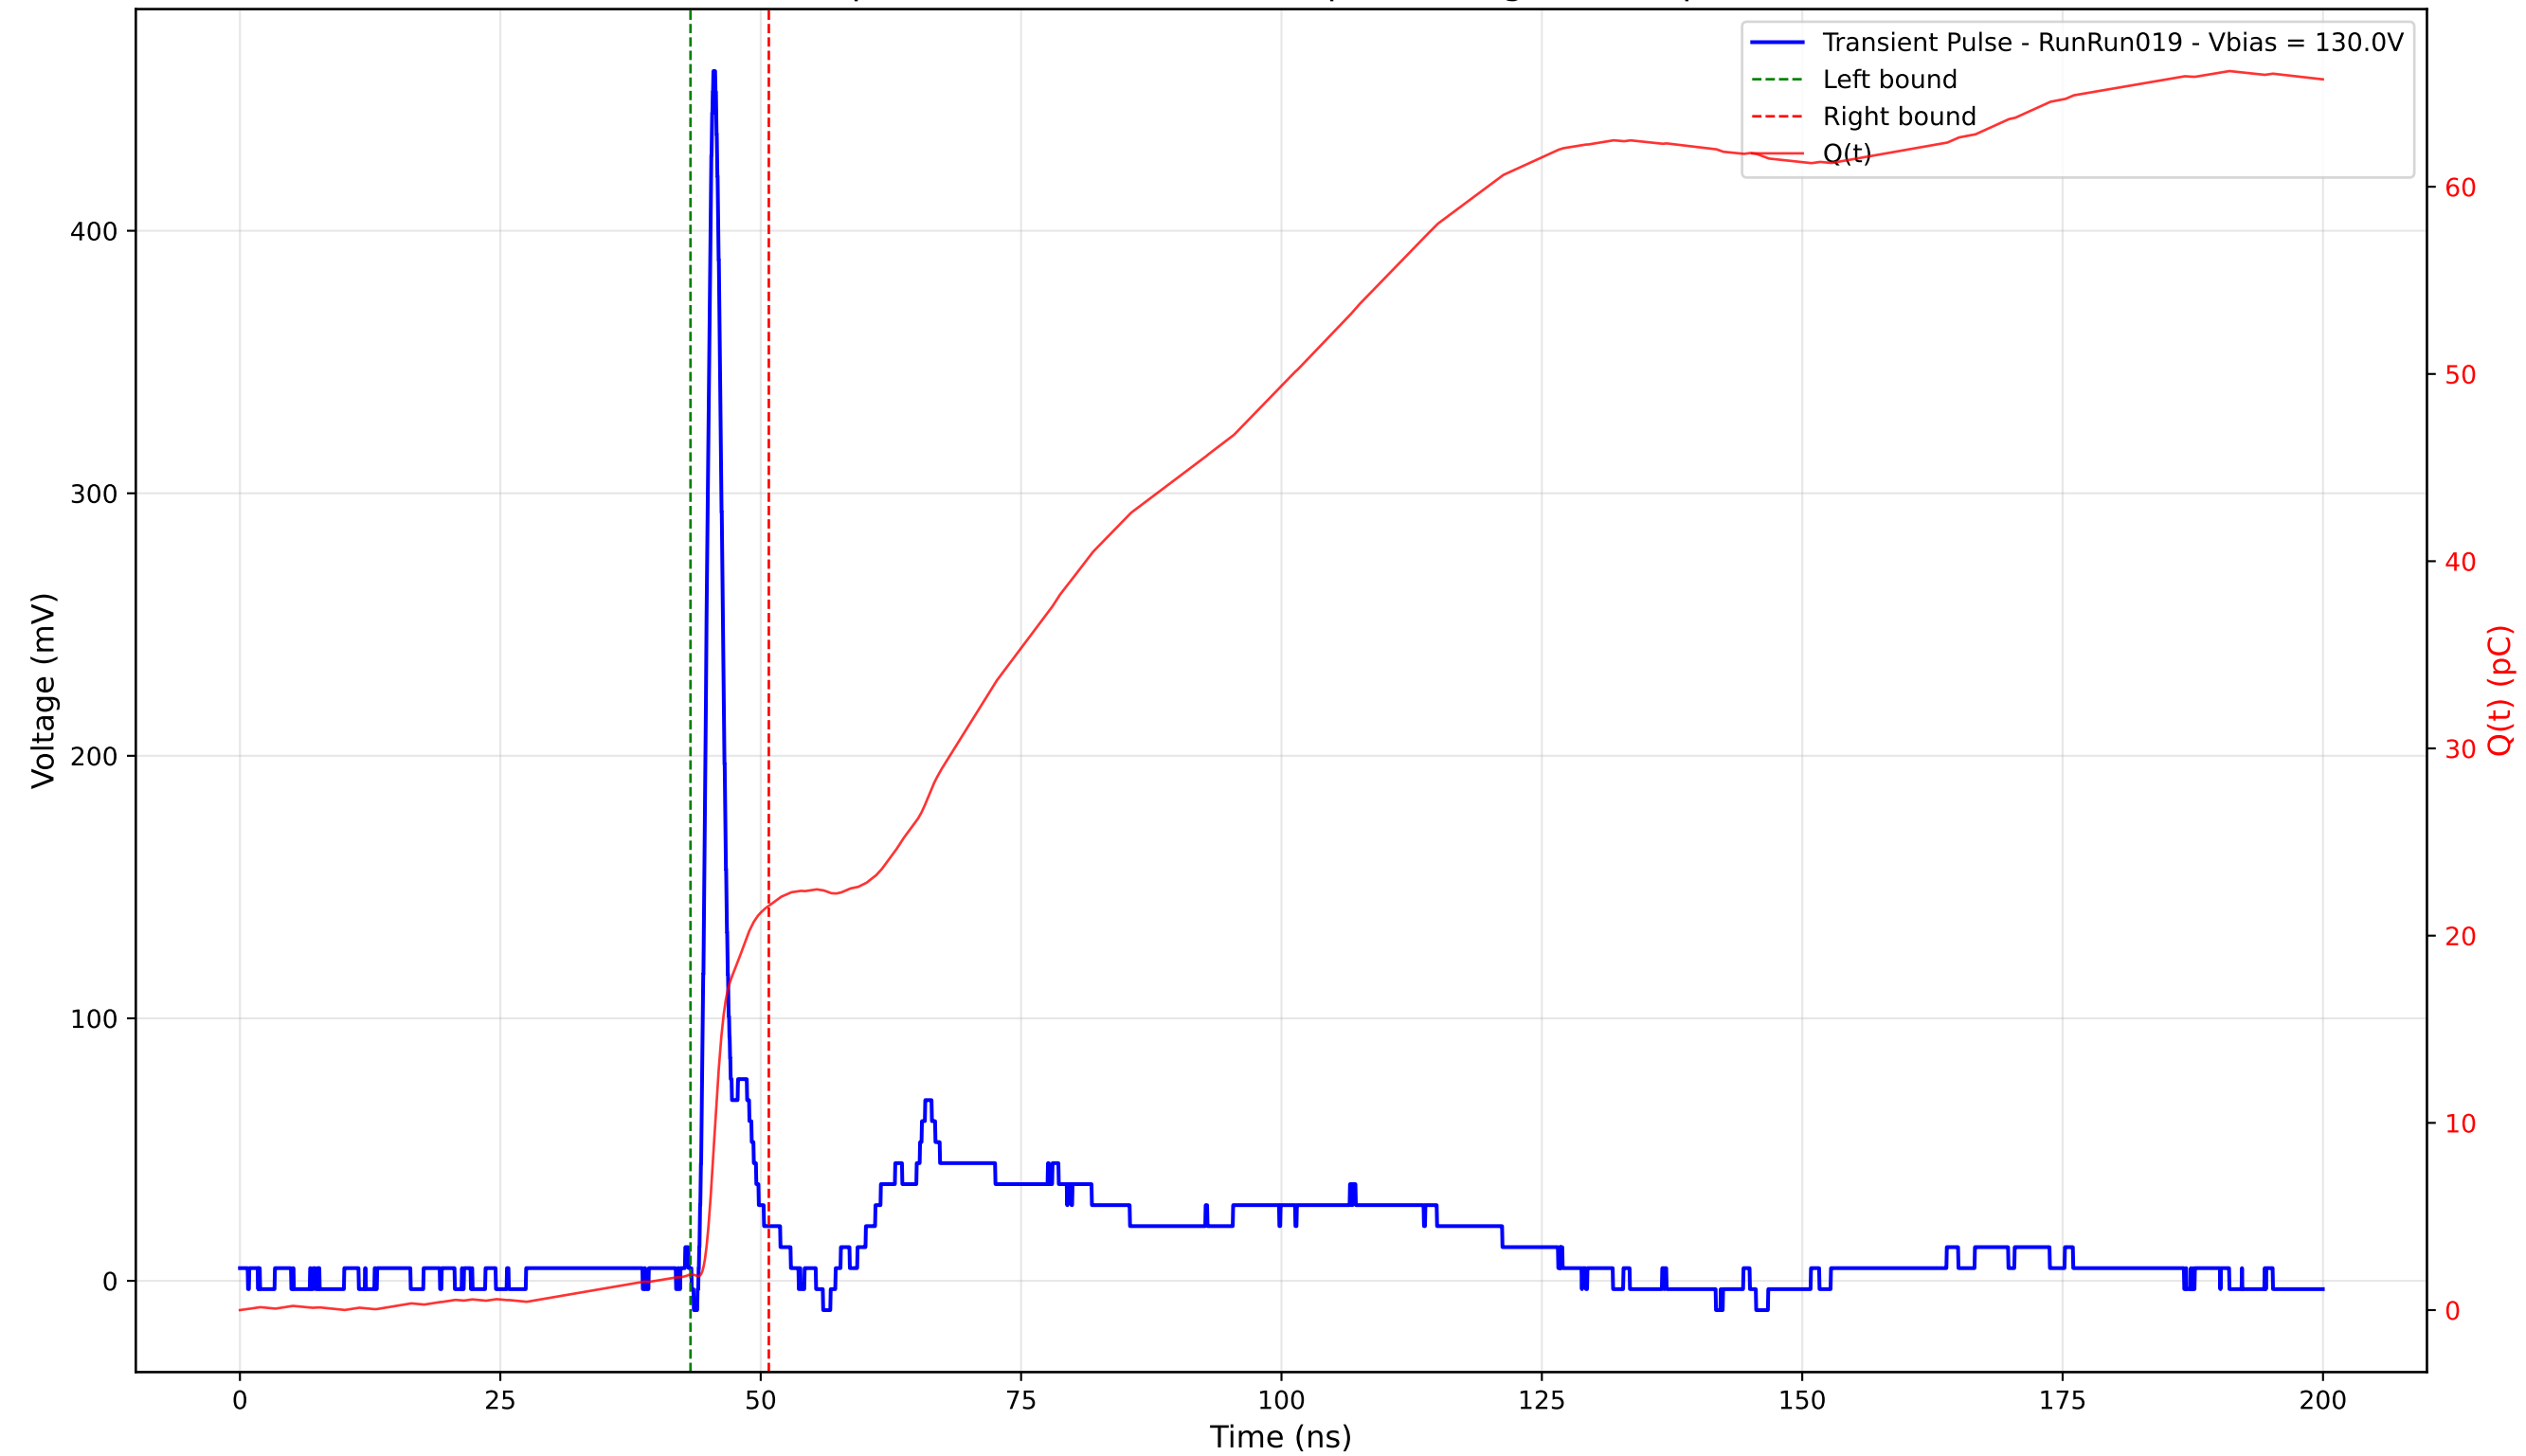


Transient Pulse - Sample: 4003 - Position: 155.0 μm - Charge: 19.45 pC - Rise Time: 0.98 ns

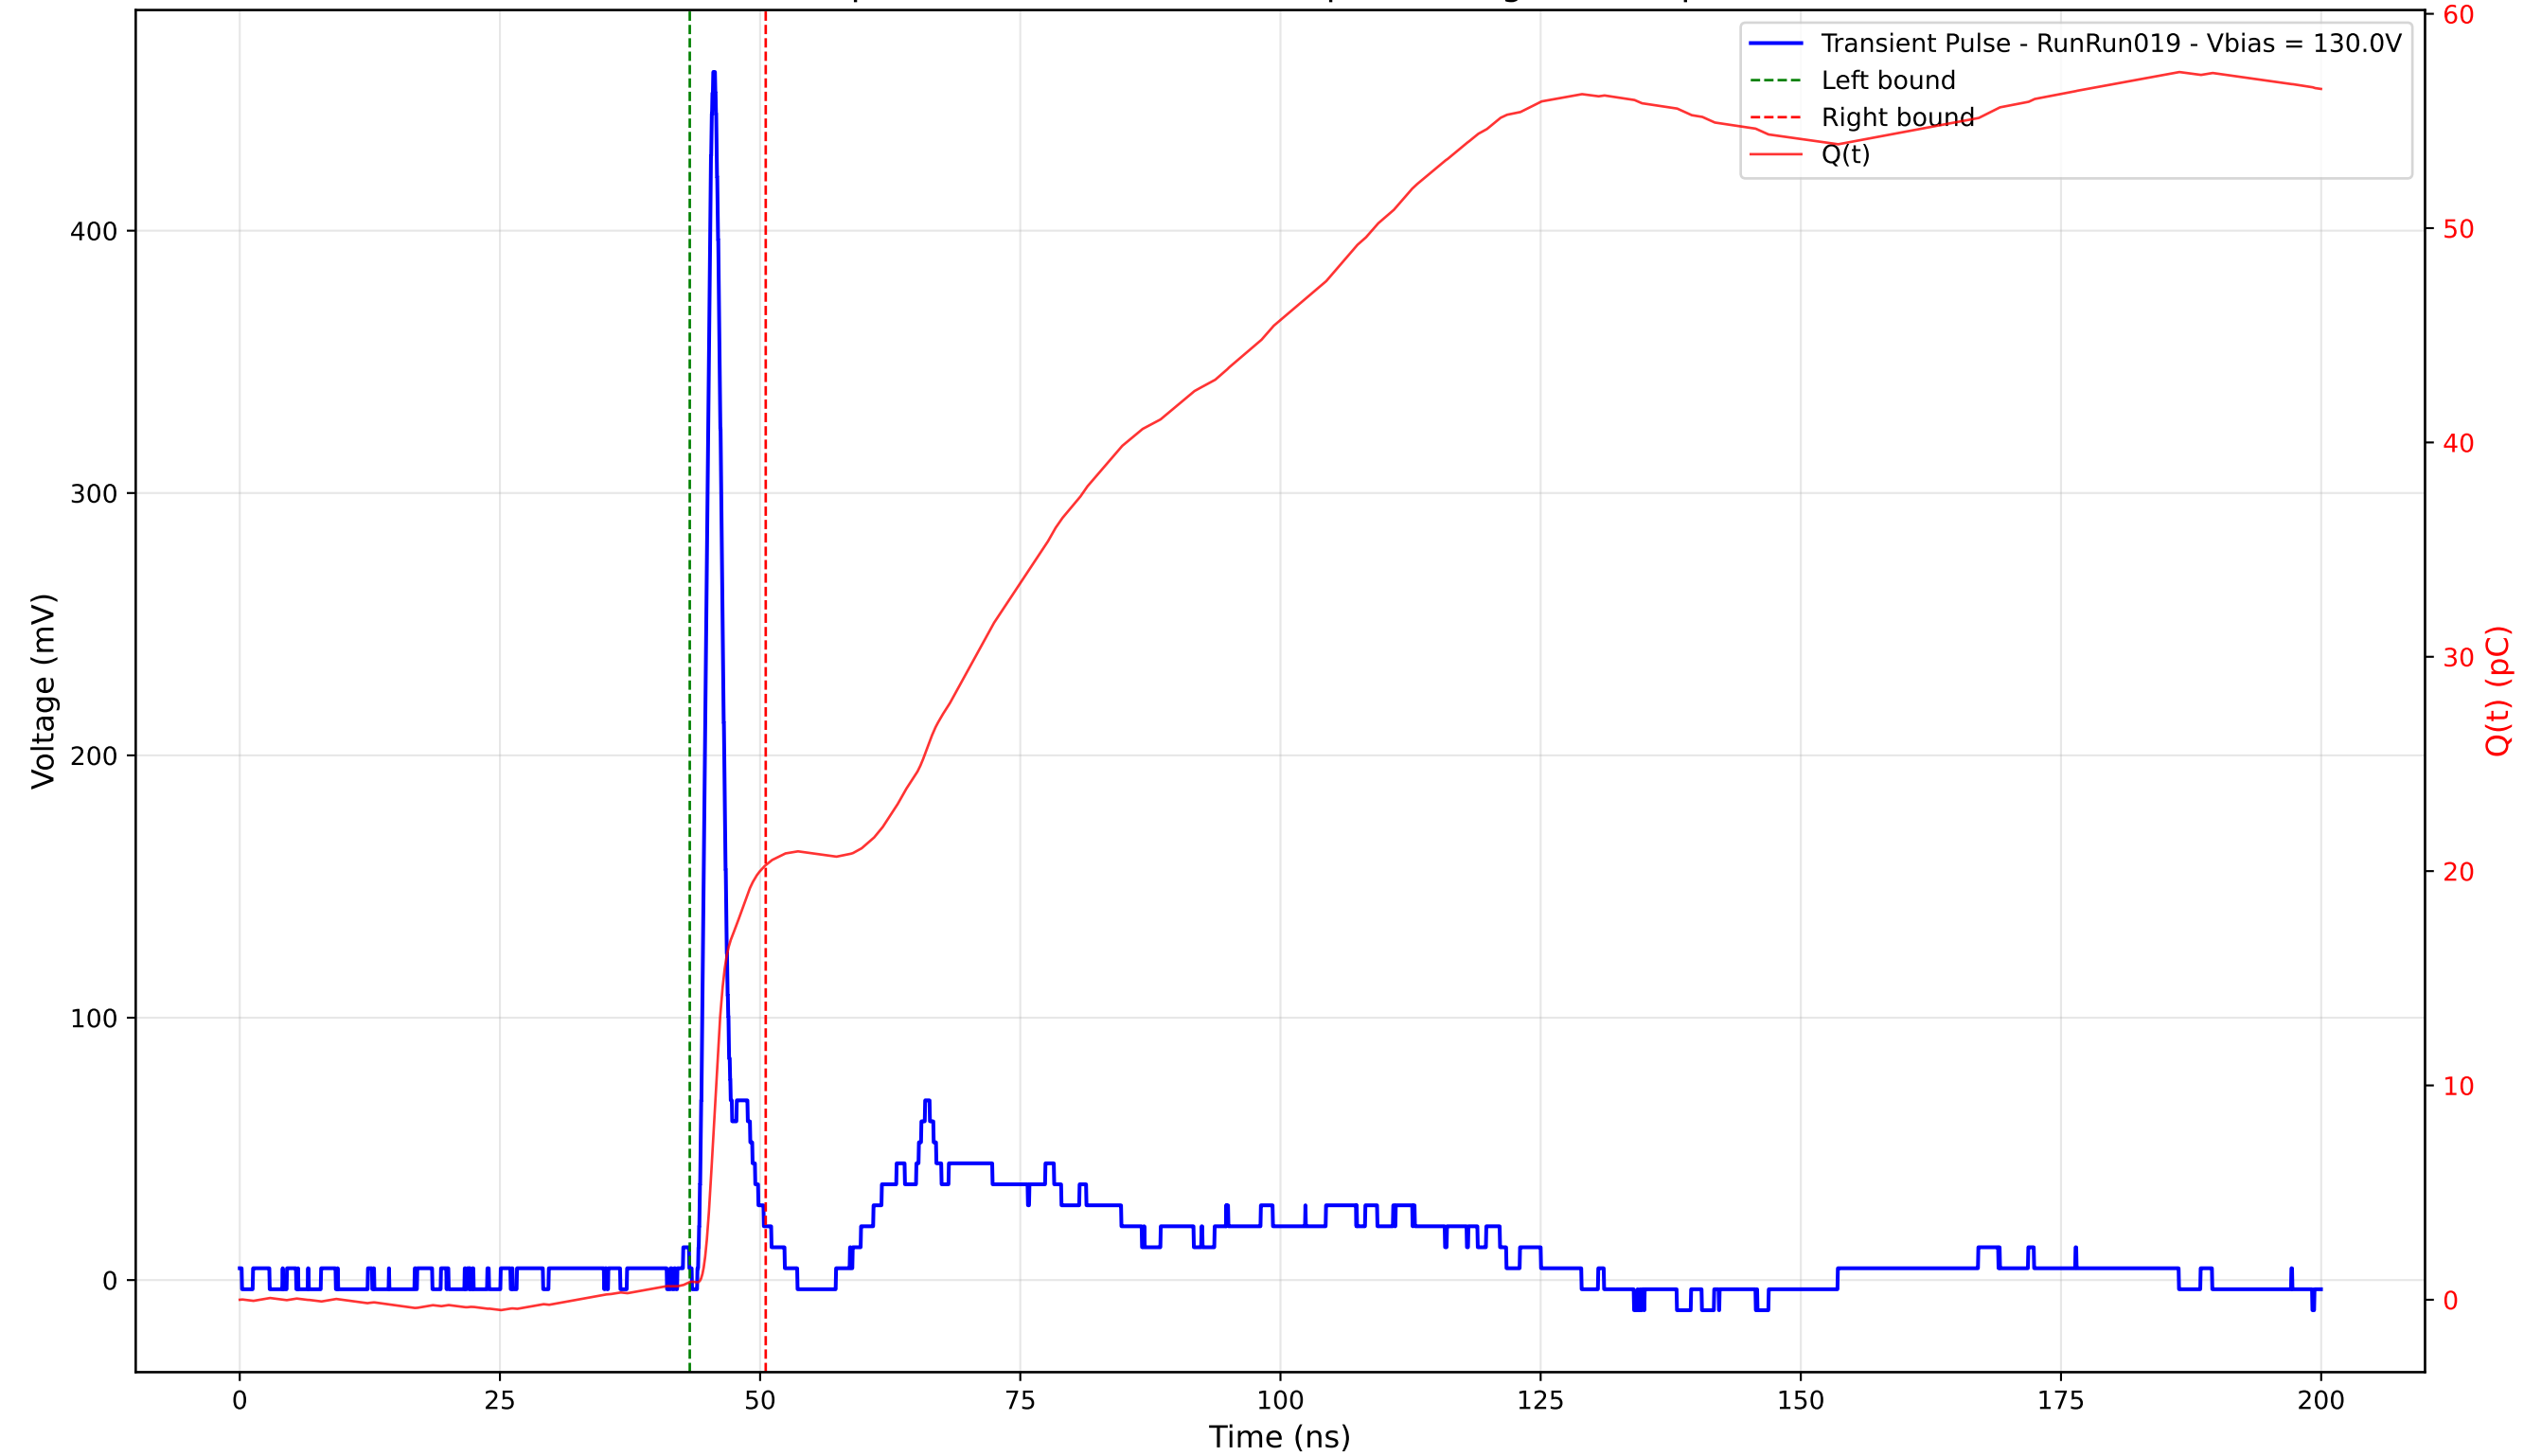


Transient Pulse - Sample: 4003 - Position: 160.0 μm - Charge: 19.27 pC - Rise Time: 0.99 ns

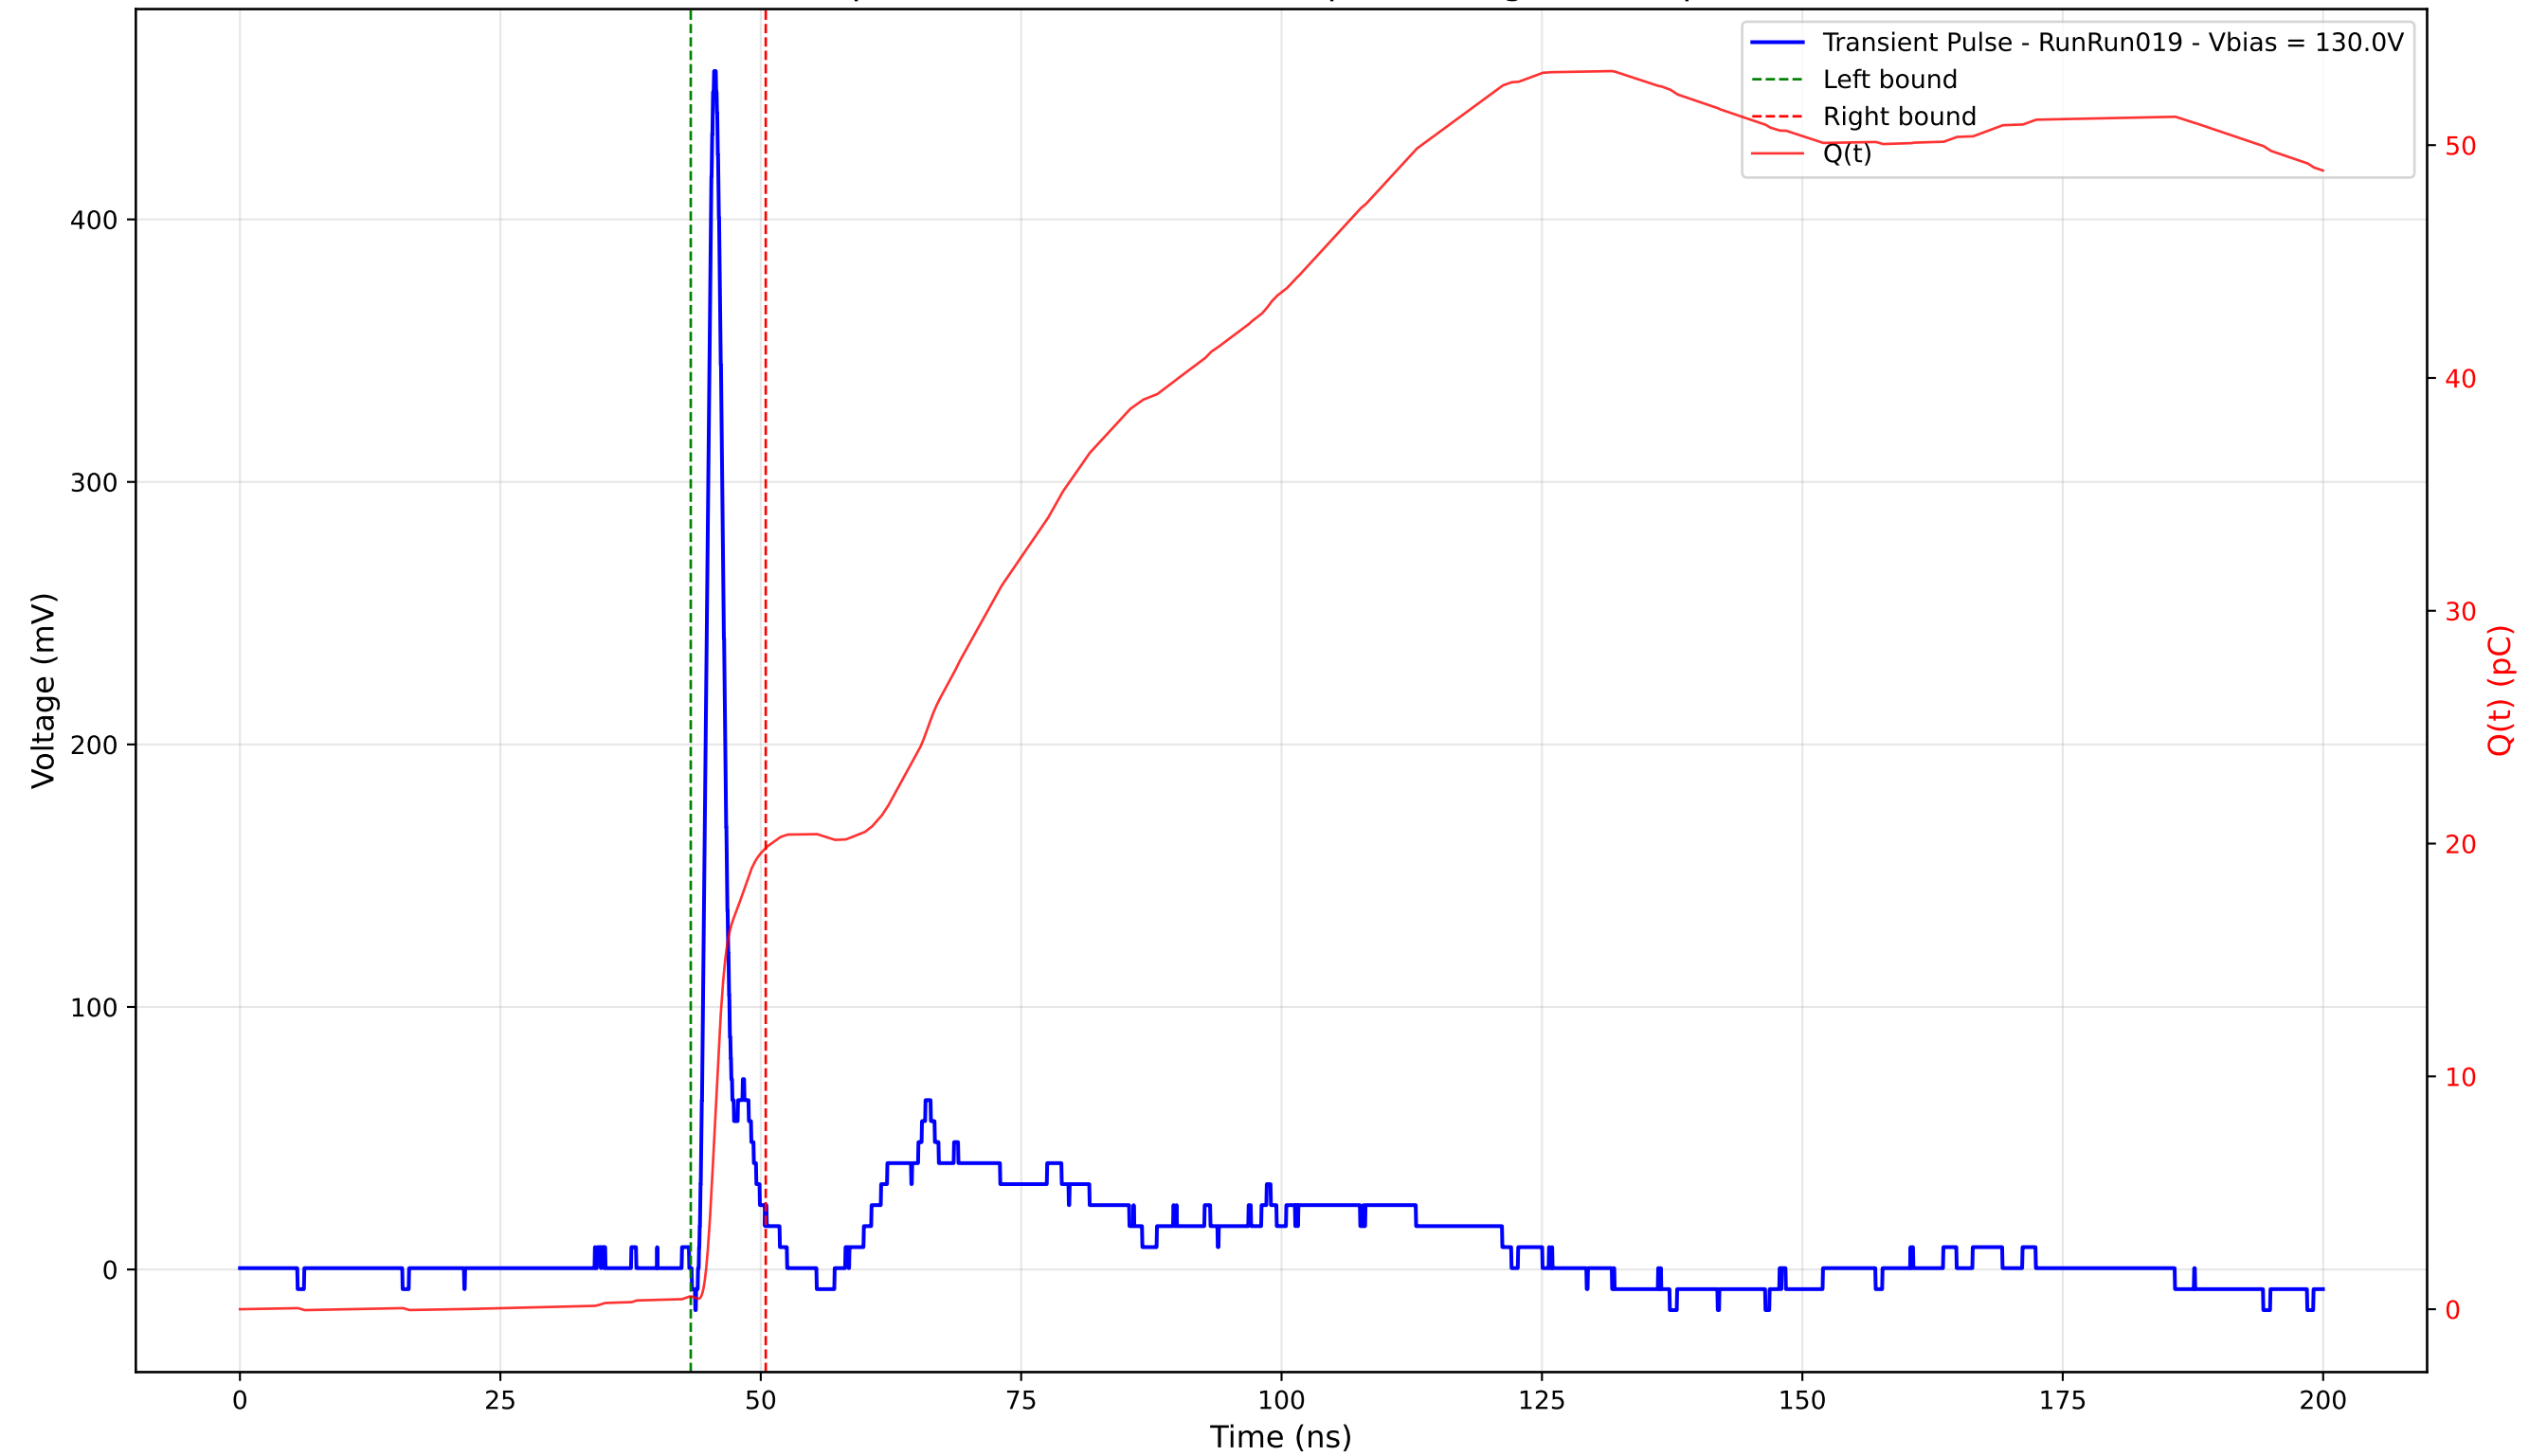


Transient Pulse - Sample: 4003 - Position: 165.0 μm - Charge: 18.93 pC - Rise Time: 1.05 ns

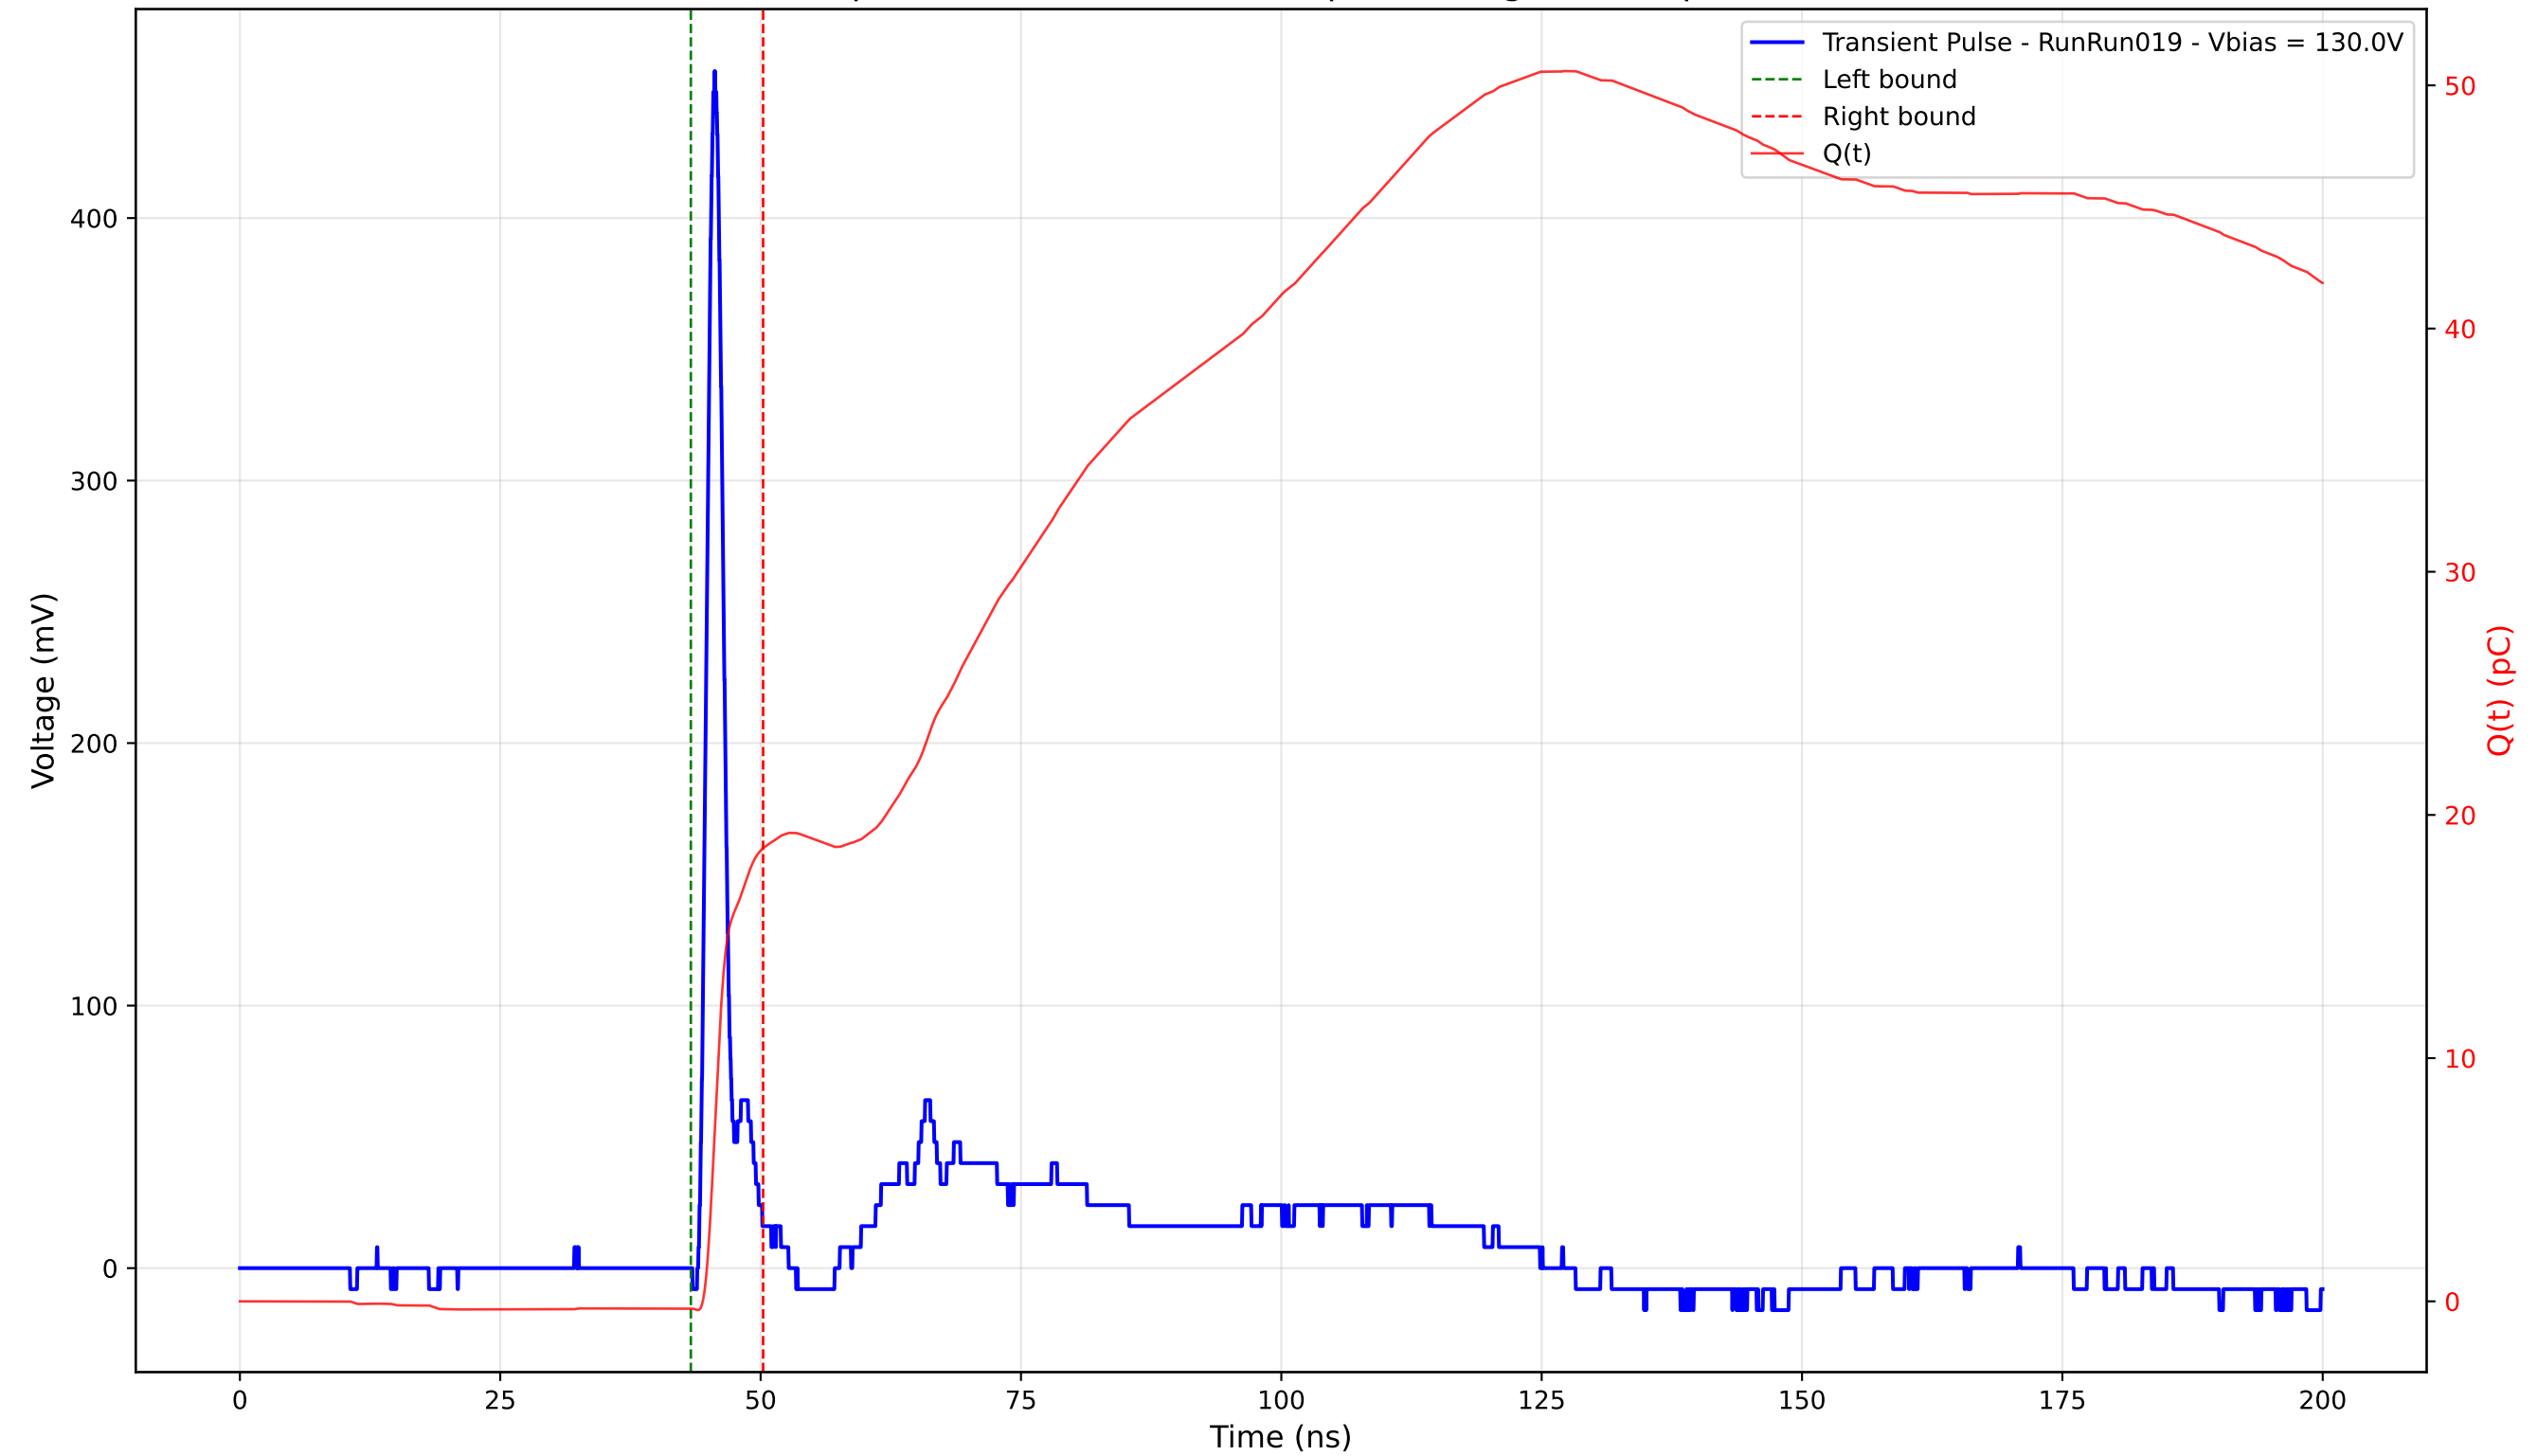


Transient Pulse - Sample: 4003 - Position: 170.0 μm - Charge: 19.28 pC - Rise Time: 1.01 ns

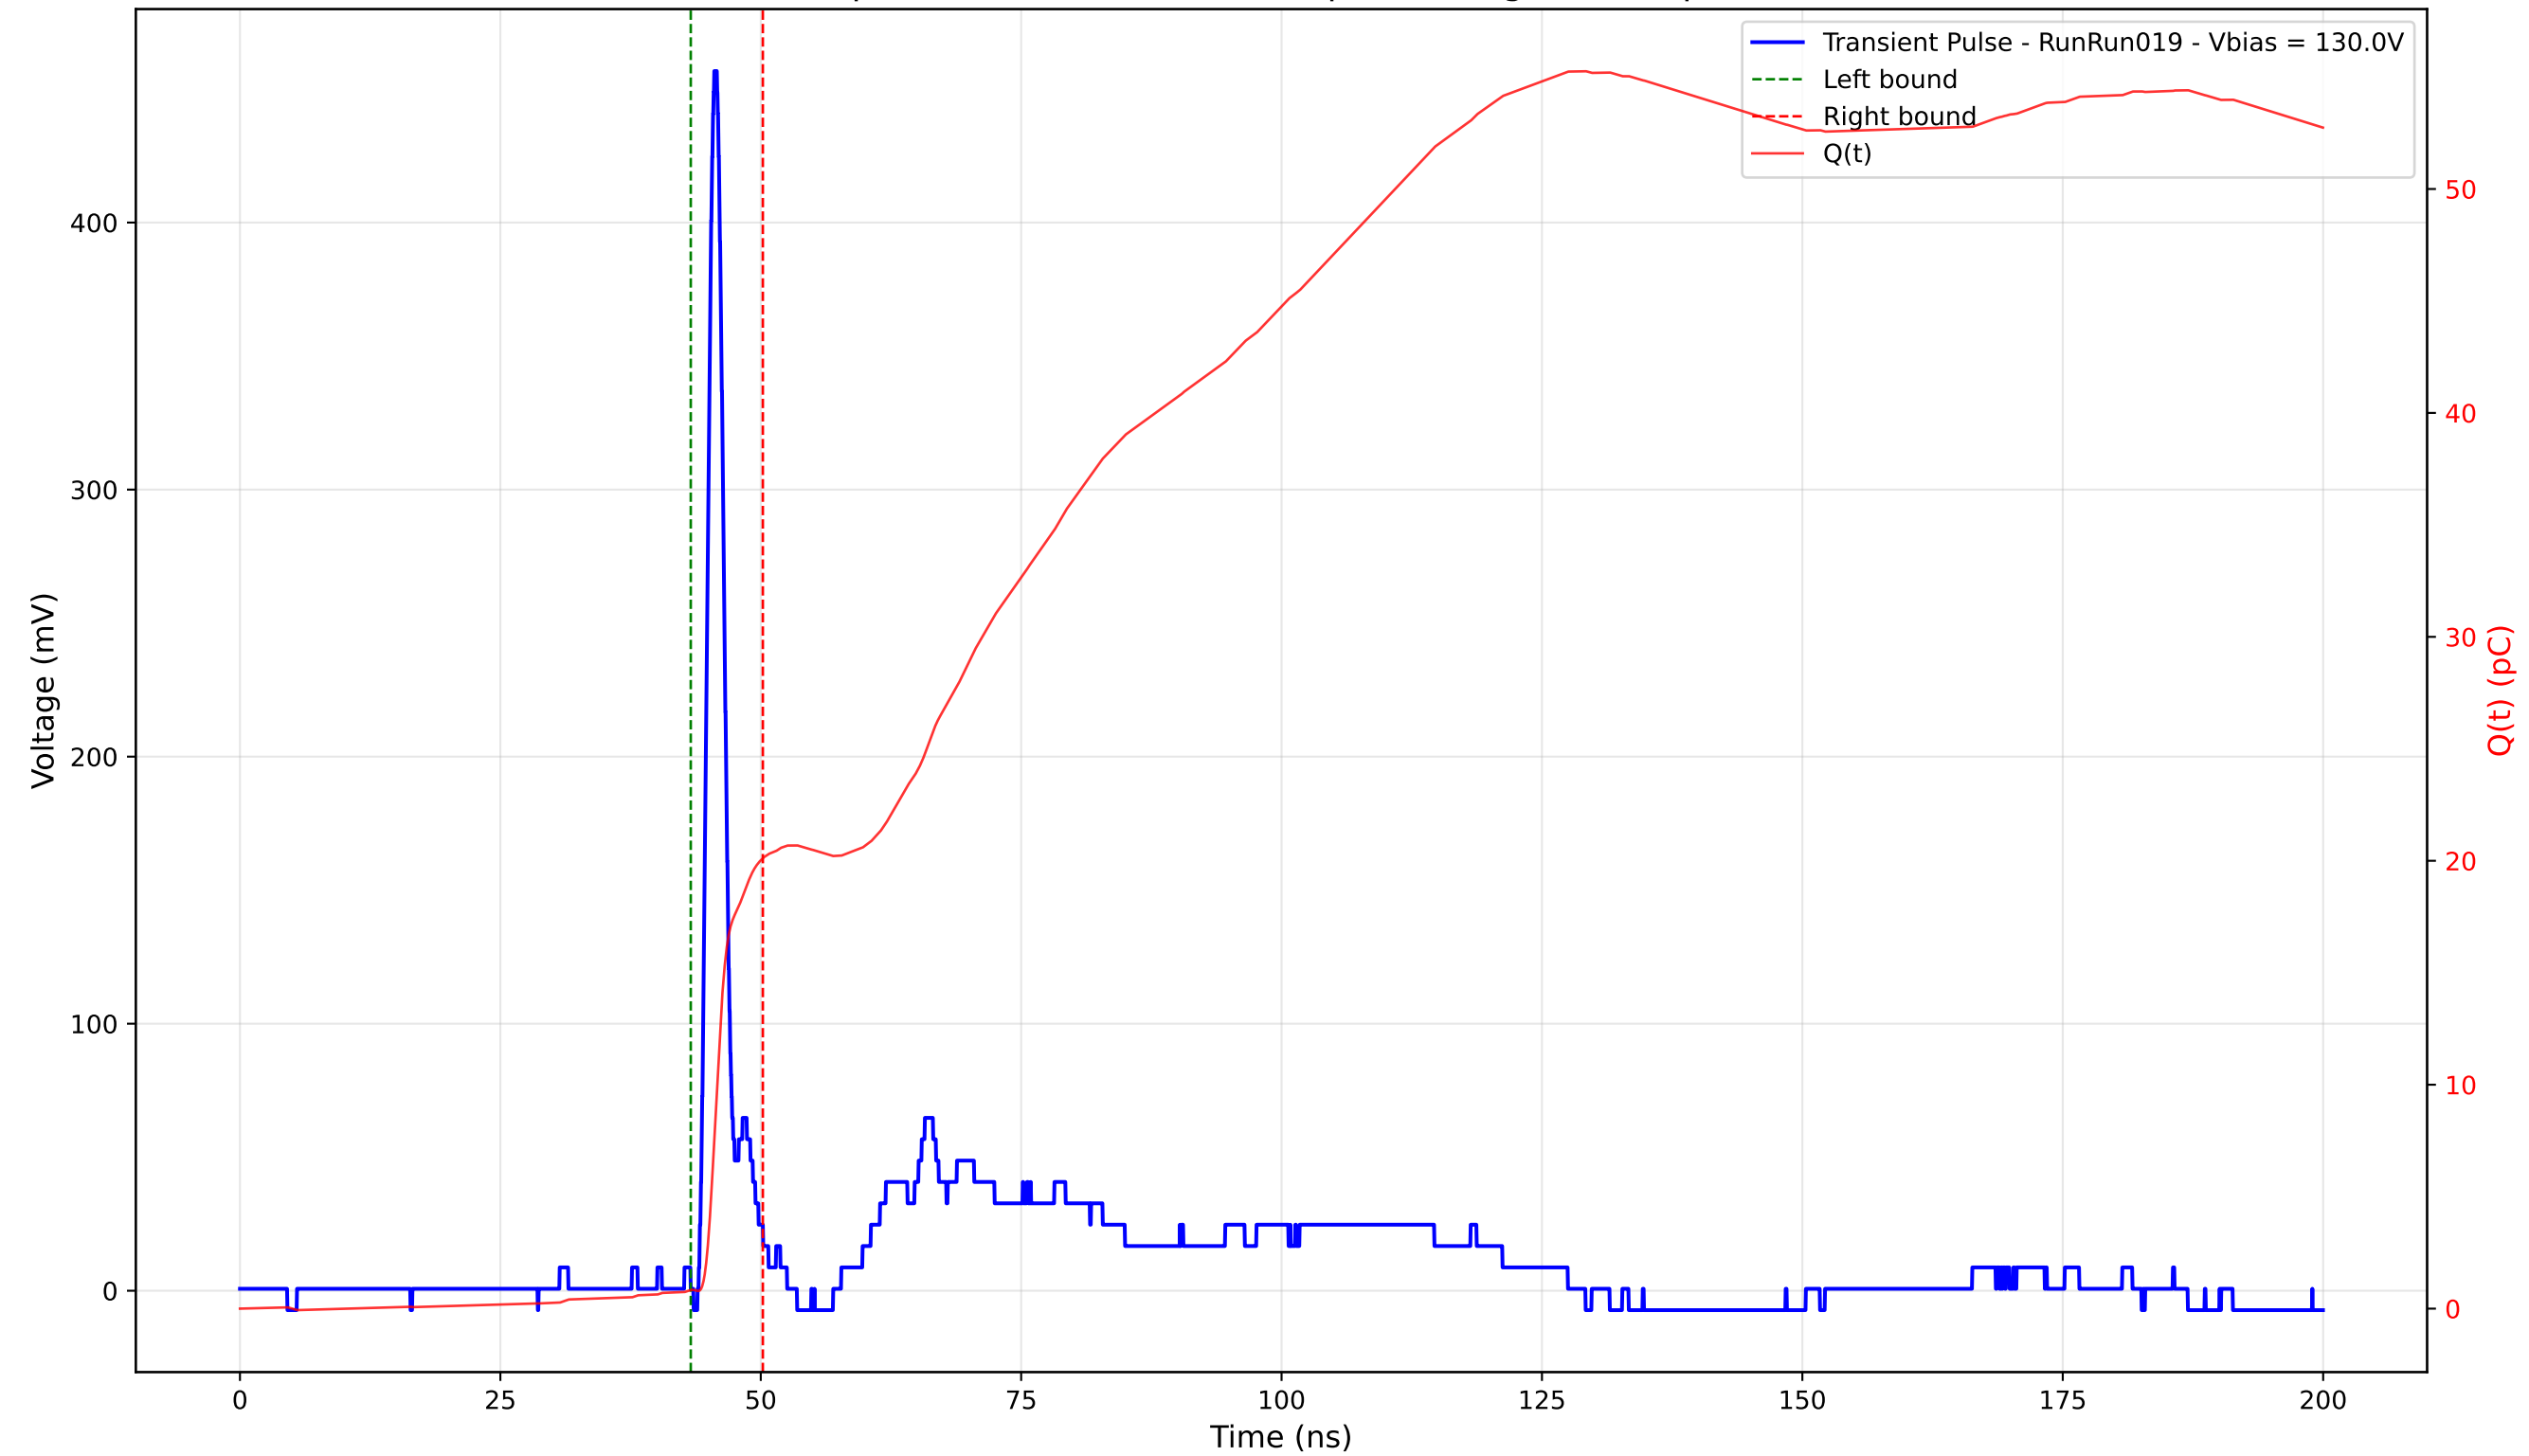


Transient Pulse - Sample: 4003 - Position: 175.0 μm - Charge: 19.00 pC - Rise Time: 1.02 ns

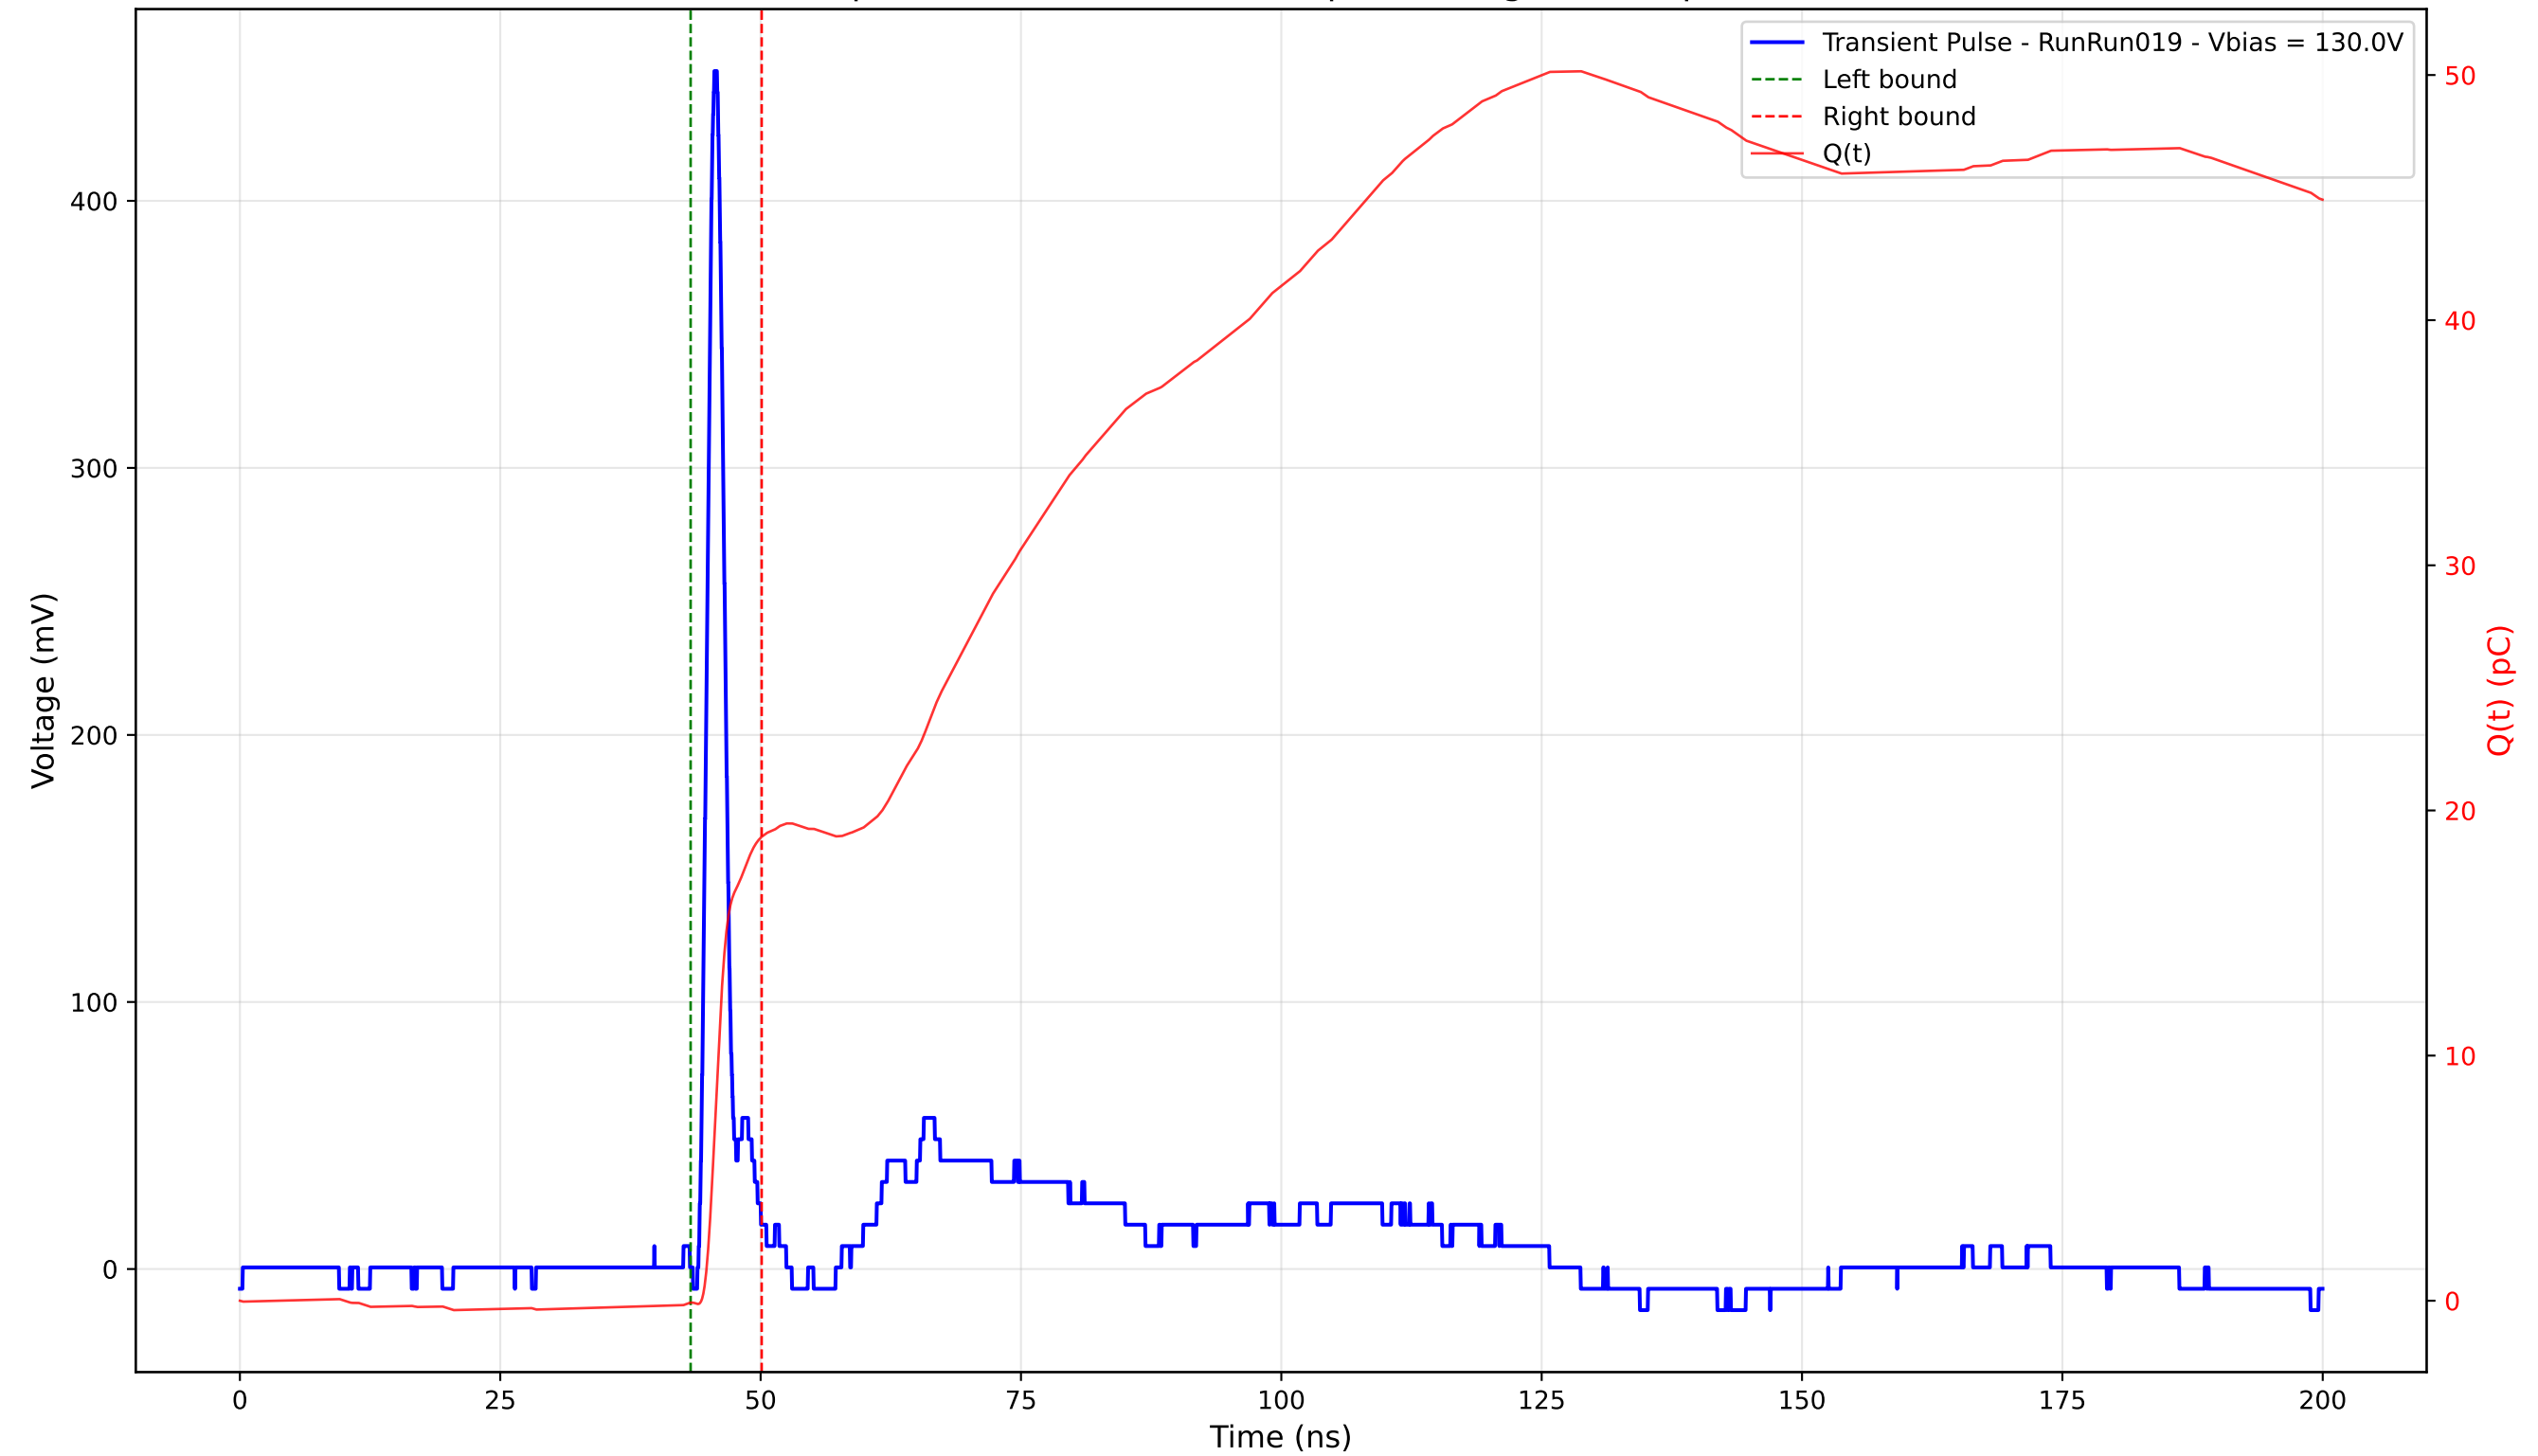


Transient Pulse - Sample: 4003 - Position: 180.0 μm - Charge: 19.32 pC - Rise Time: 1.05 ns

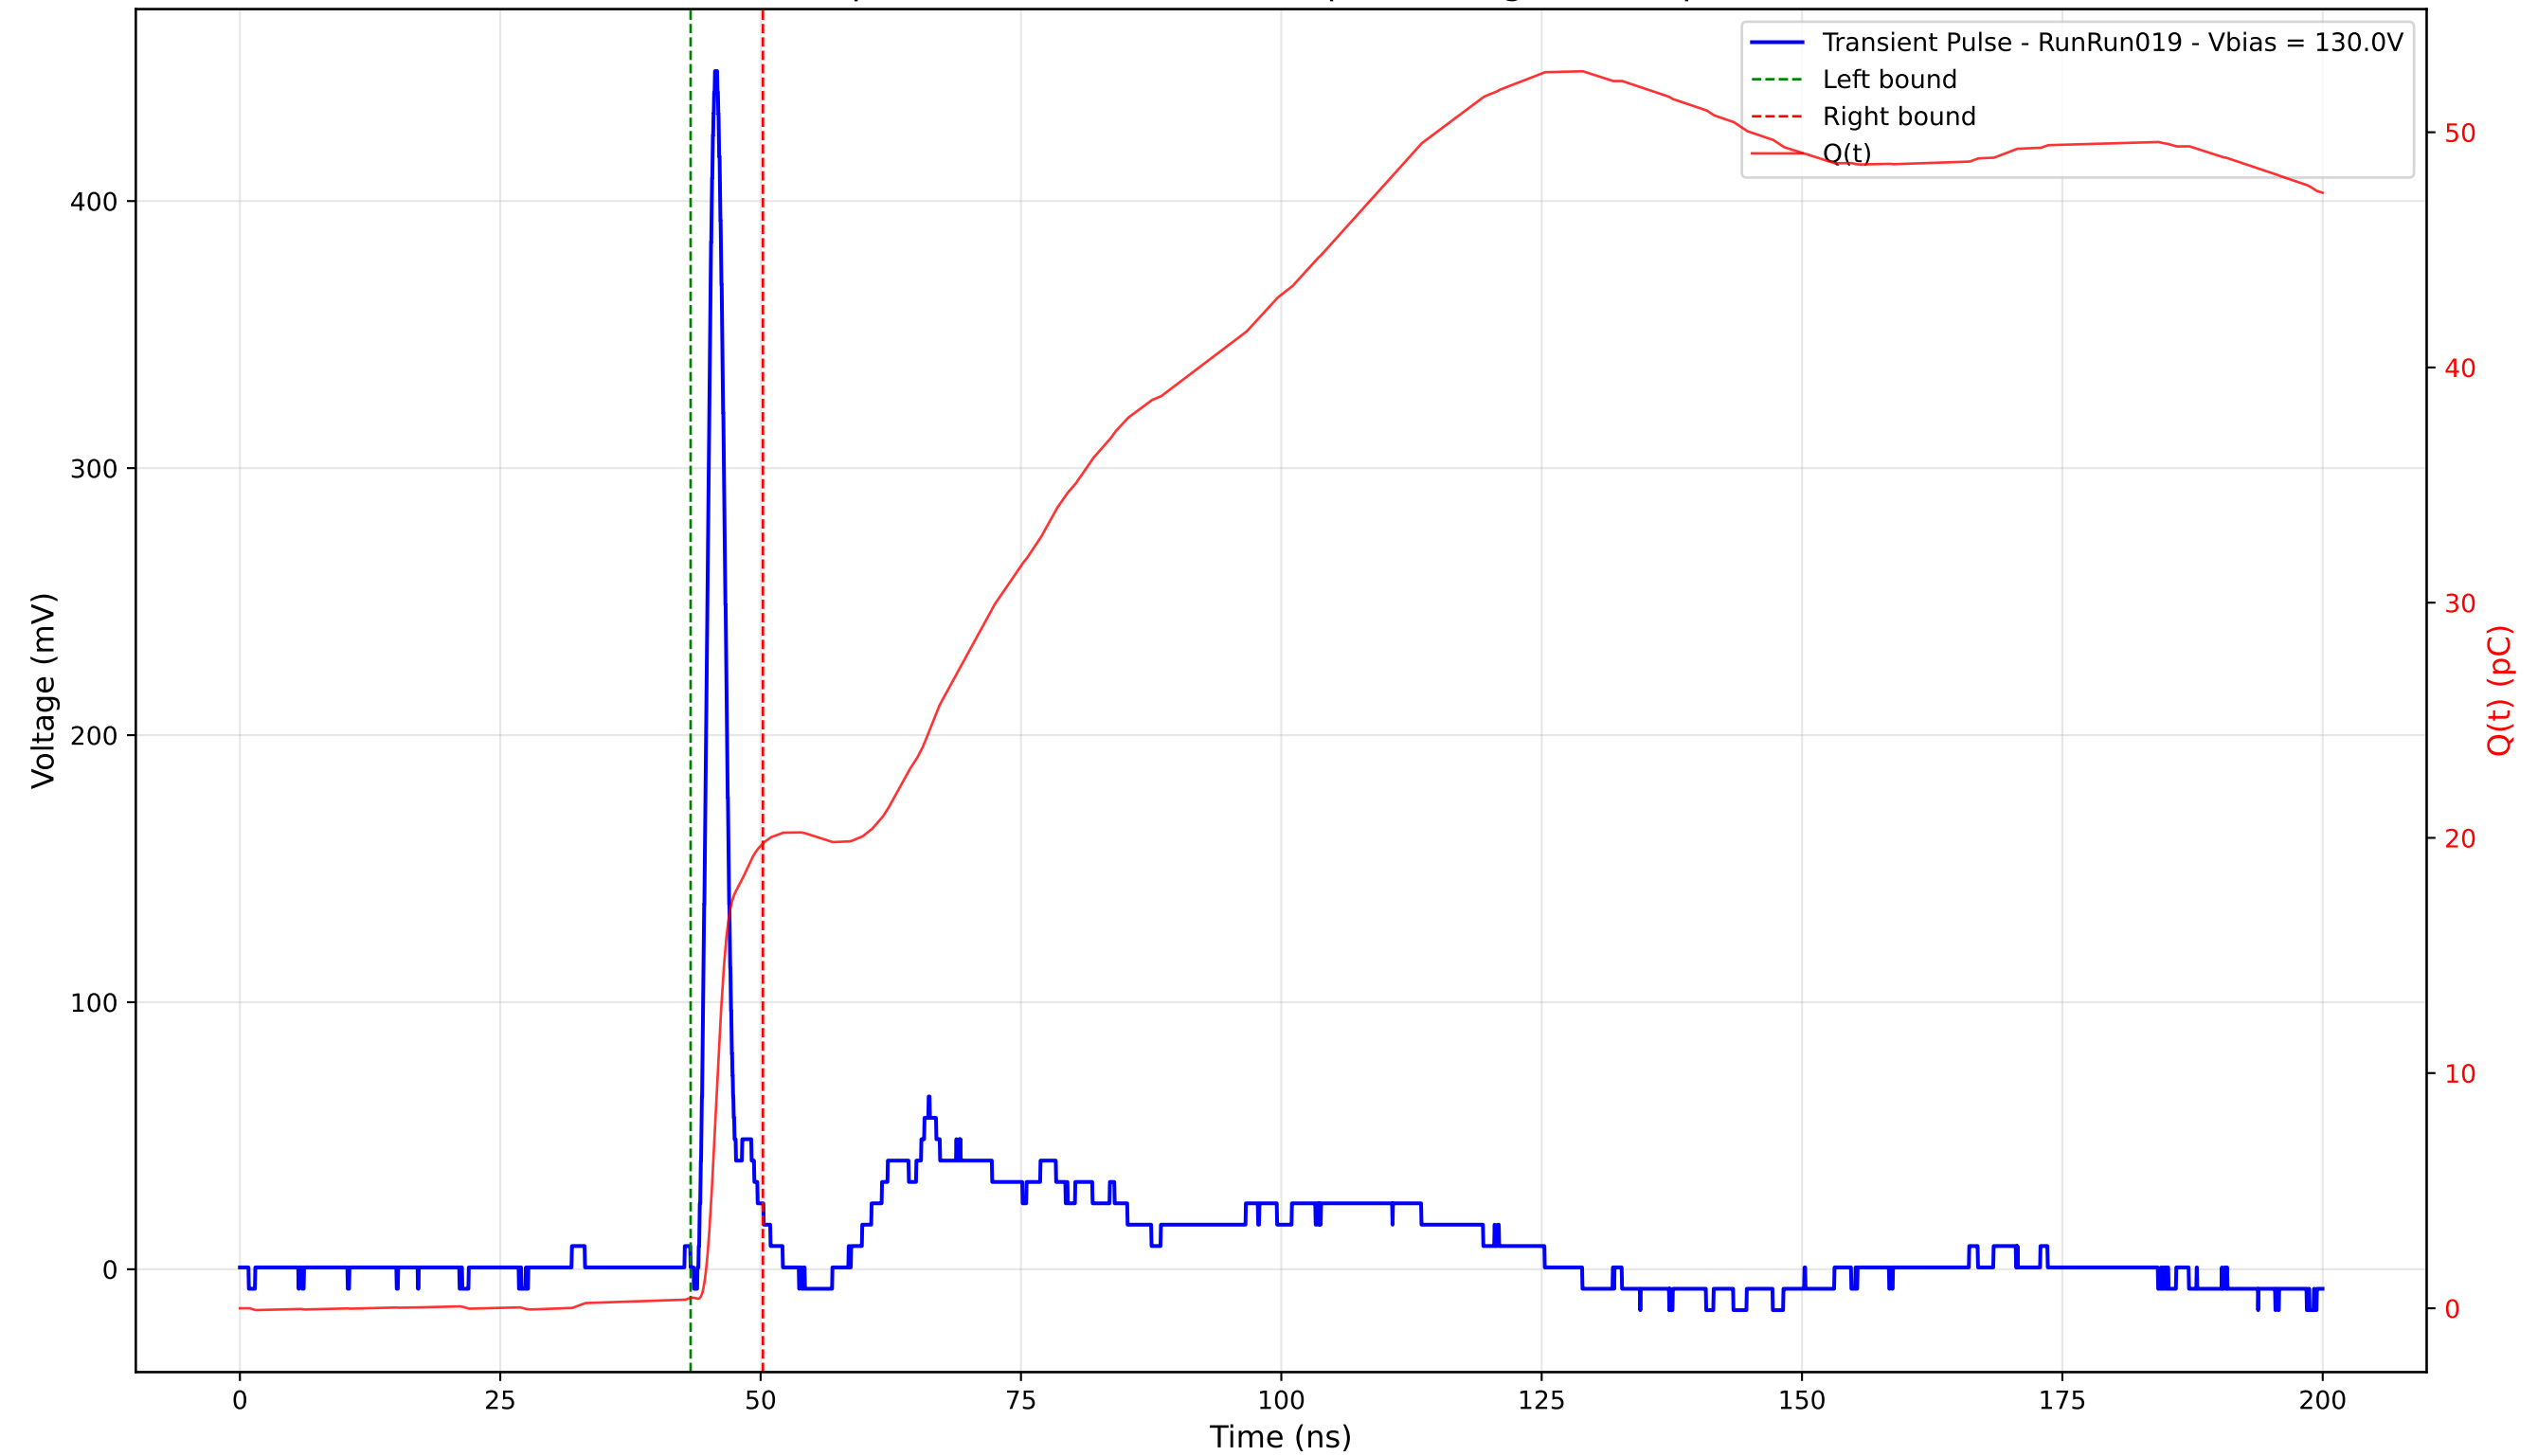


Transient Pulse - Sample: 4003 - Position: 185.0 μm - Charge: 19.38 pC - Rise Time: 1.09 ns

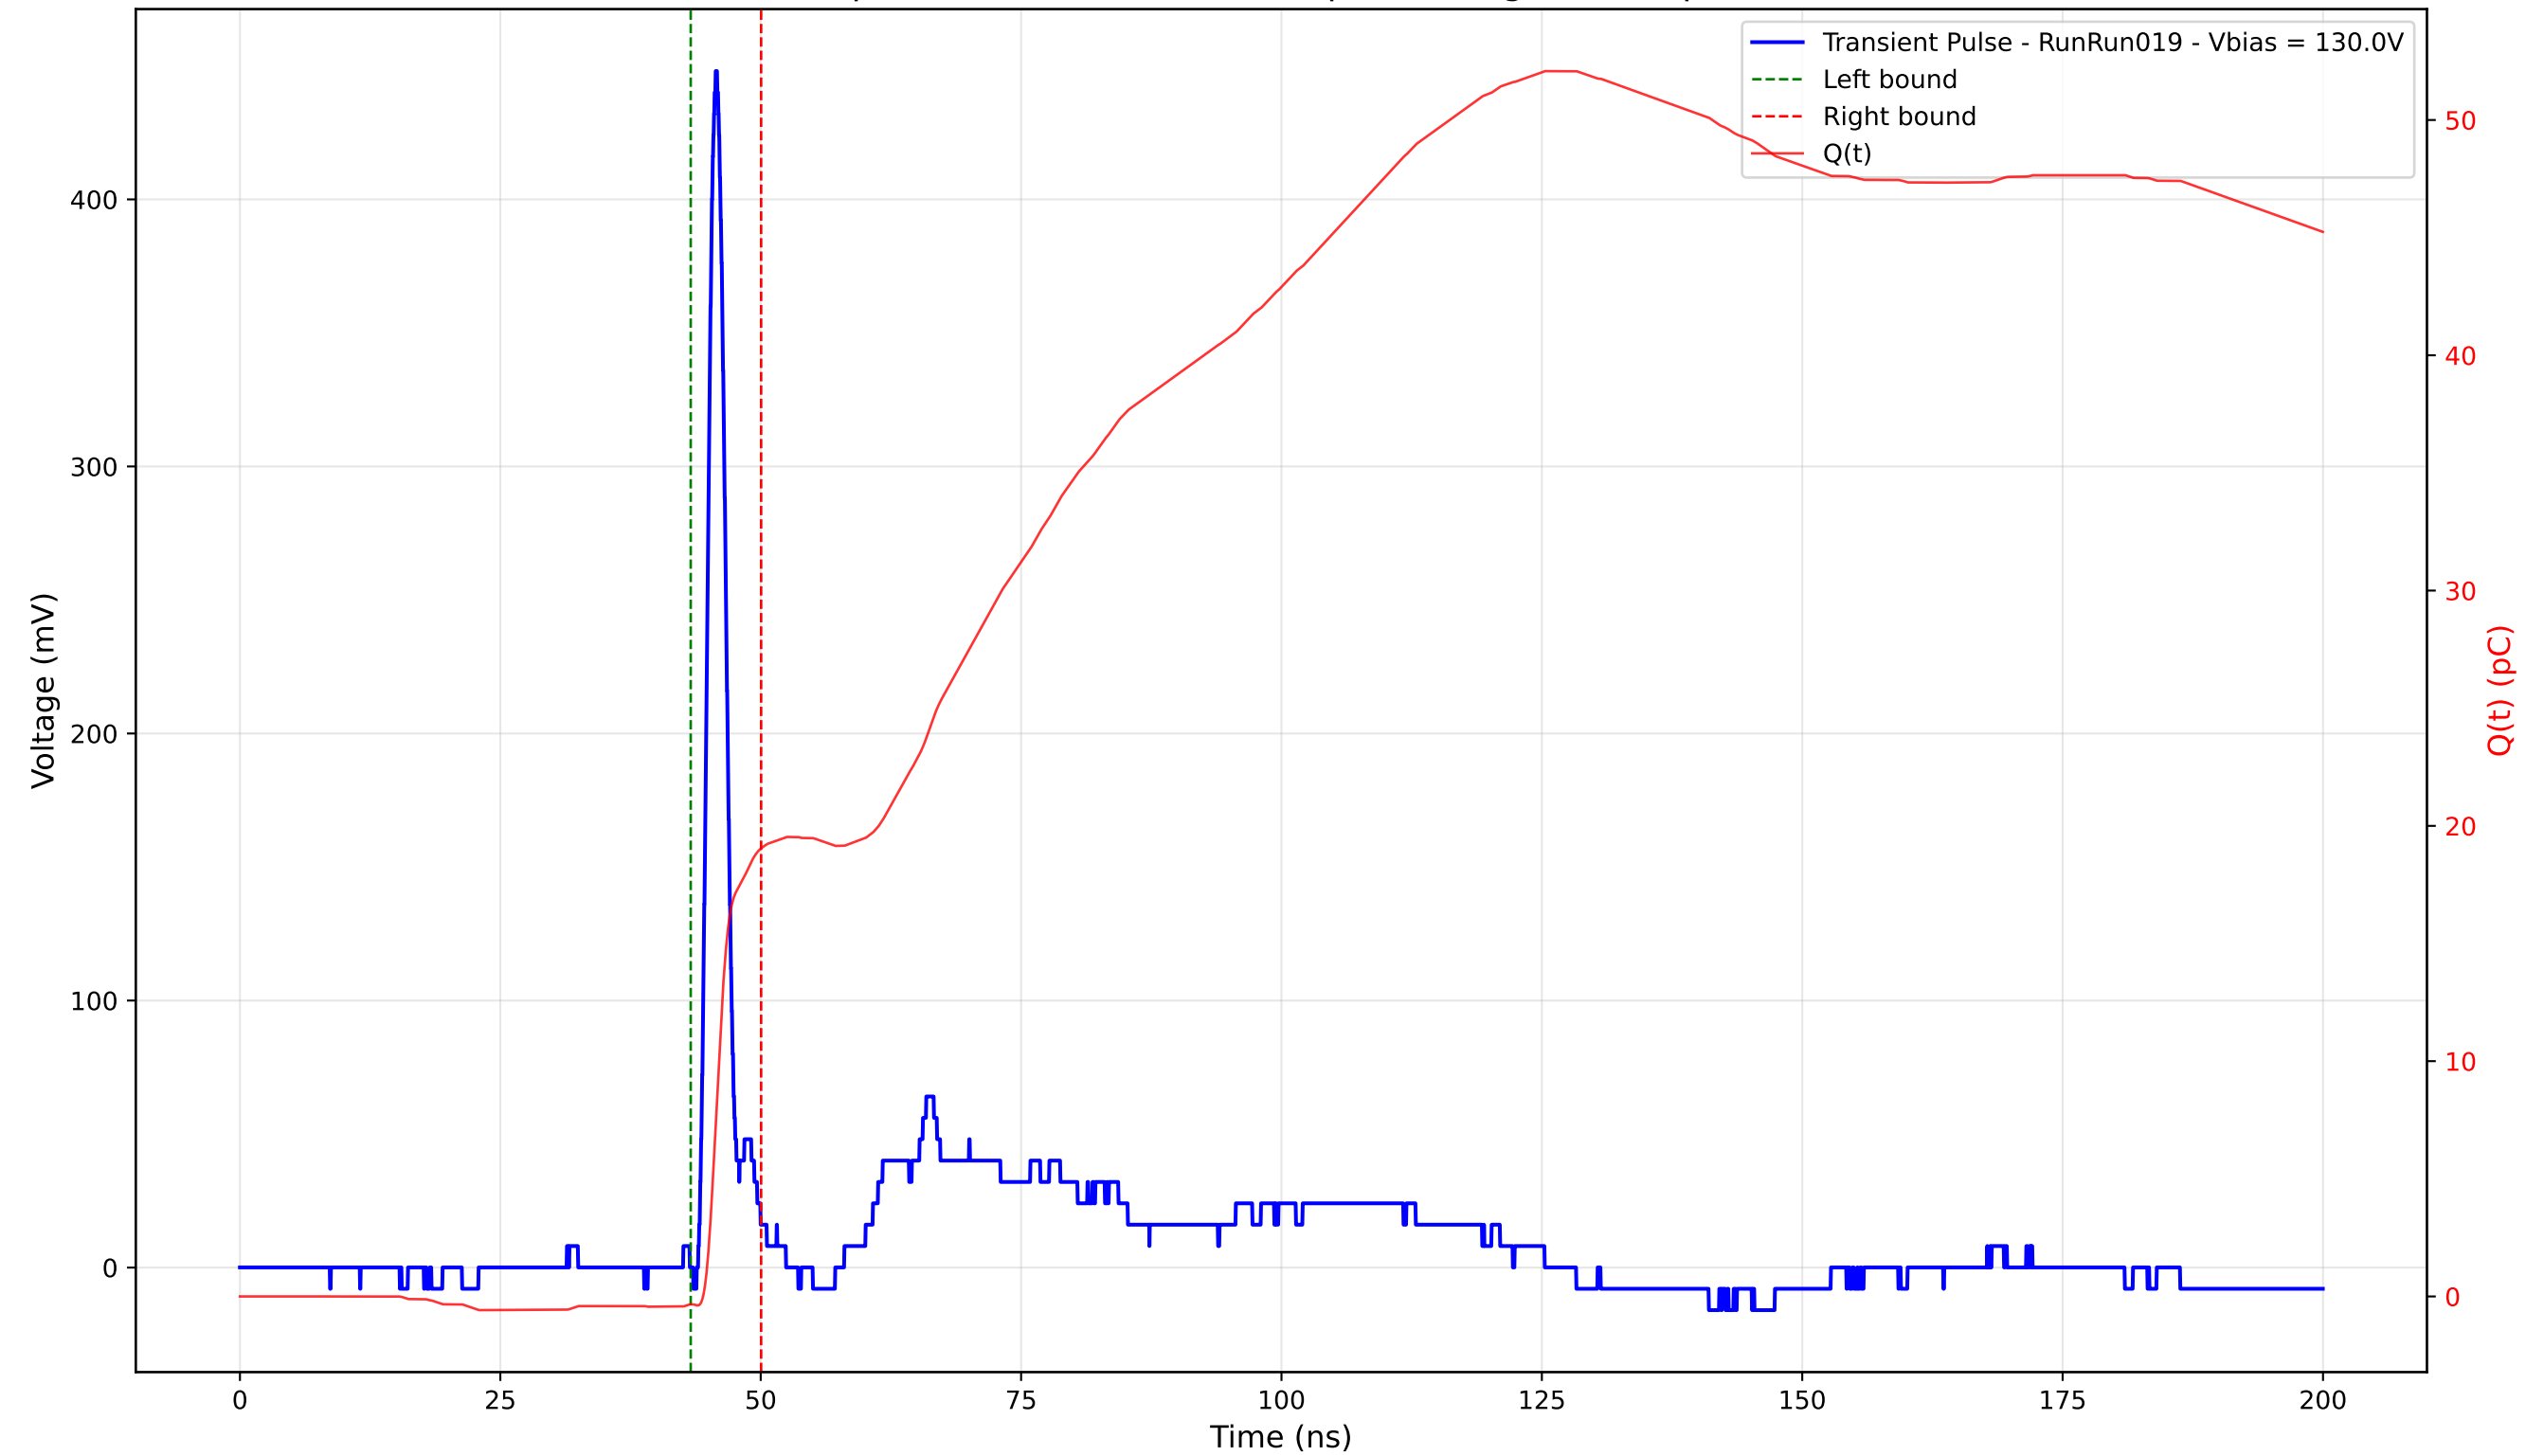


Transient Pulse - Sample: 4003 - Position: 190.0 μm - Charge: 19.23 pC - Rise Time: 1.07 ns

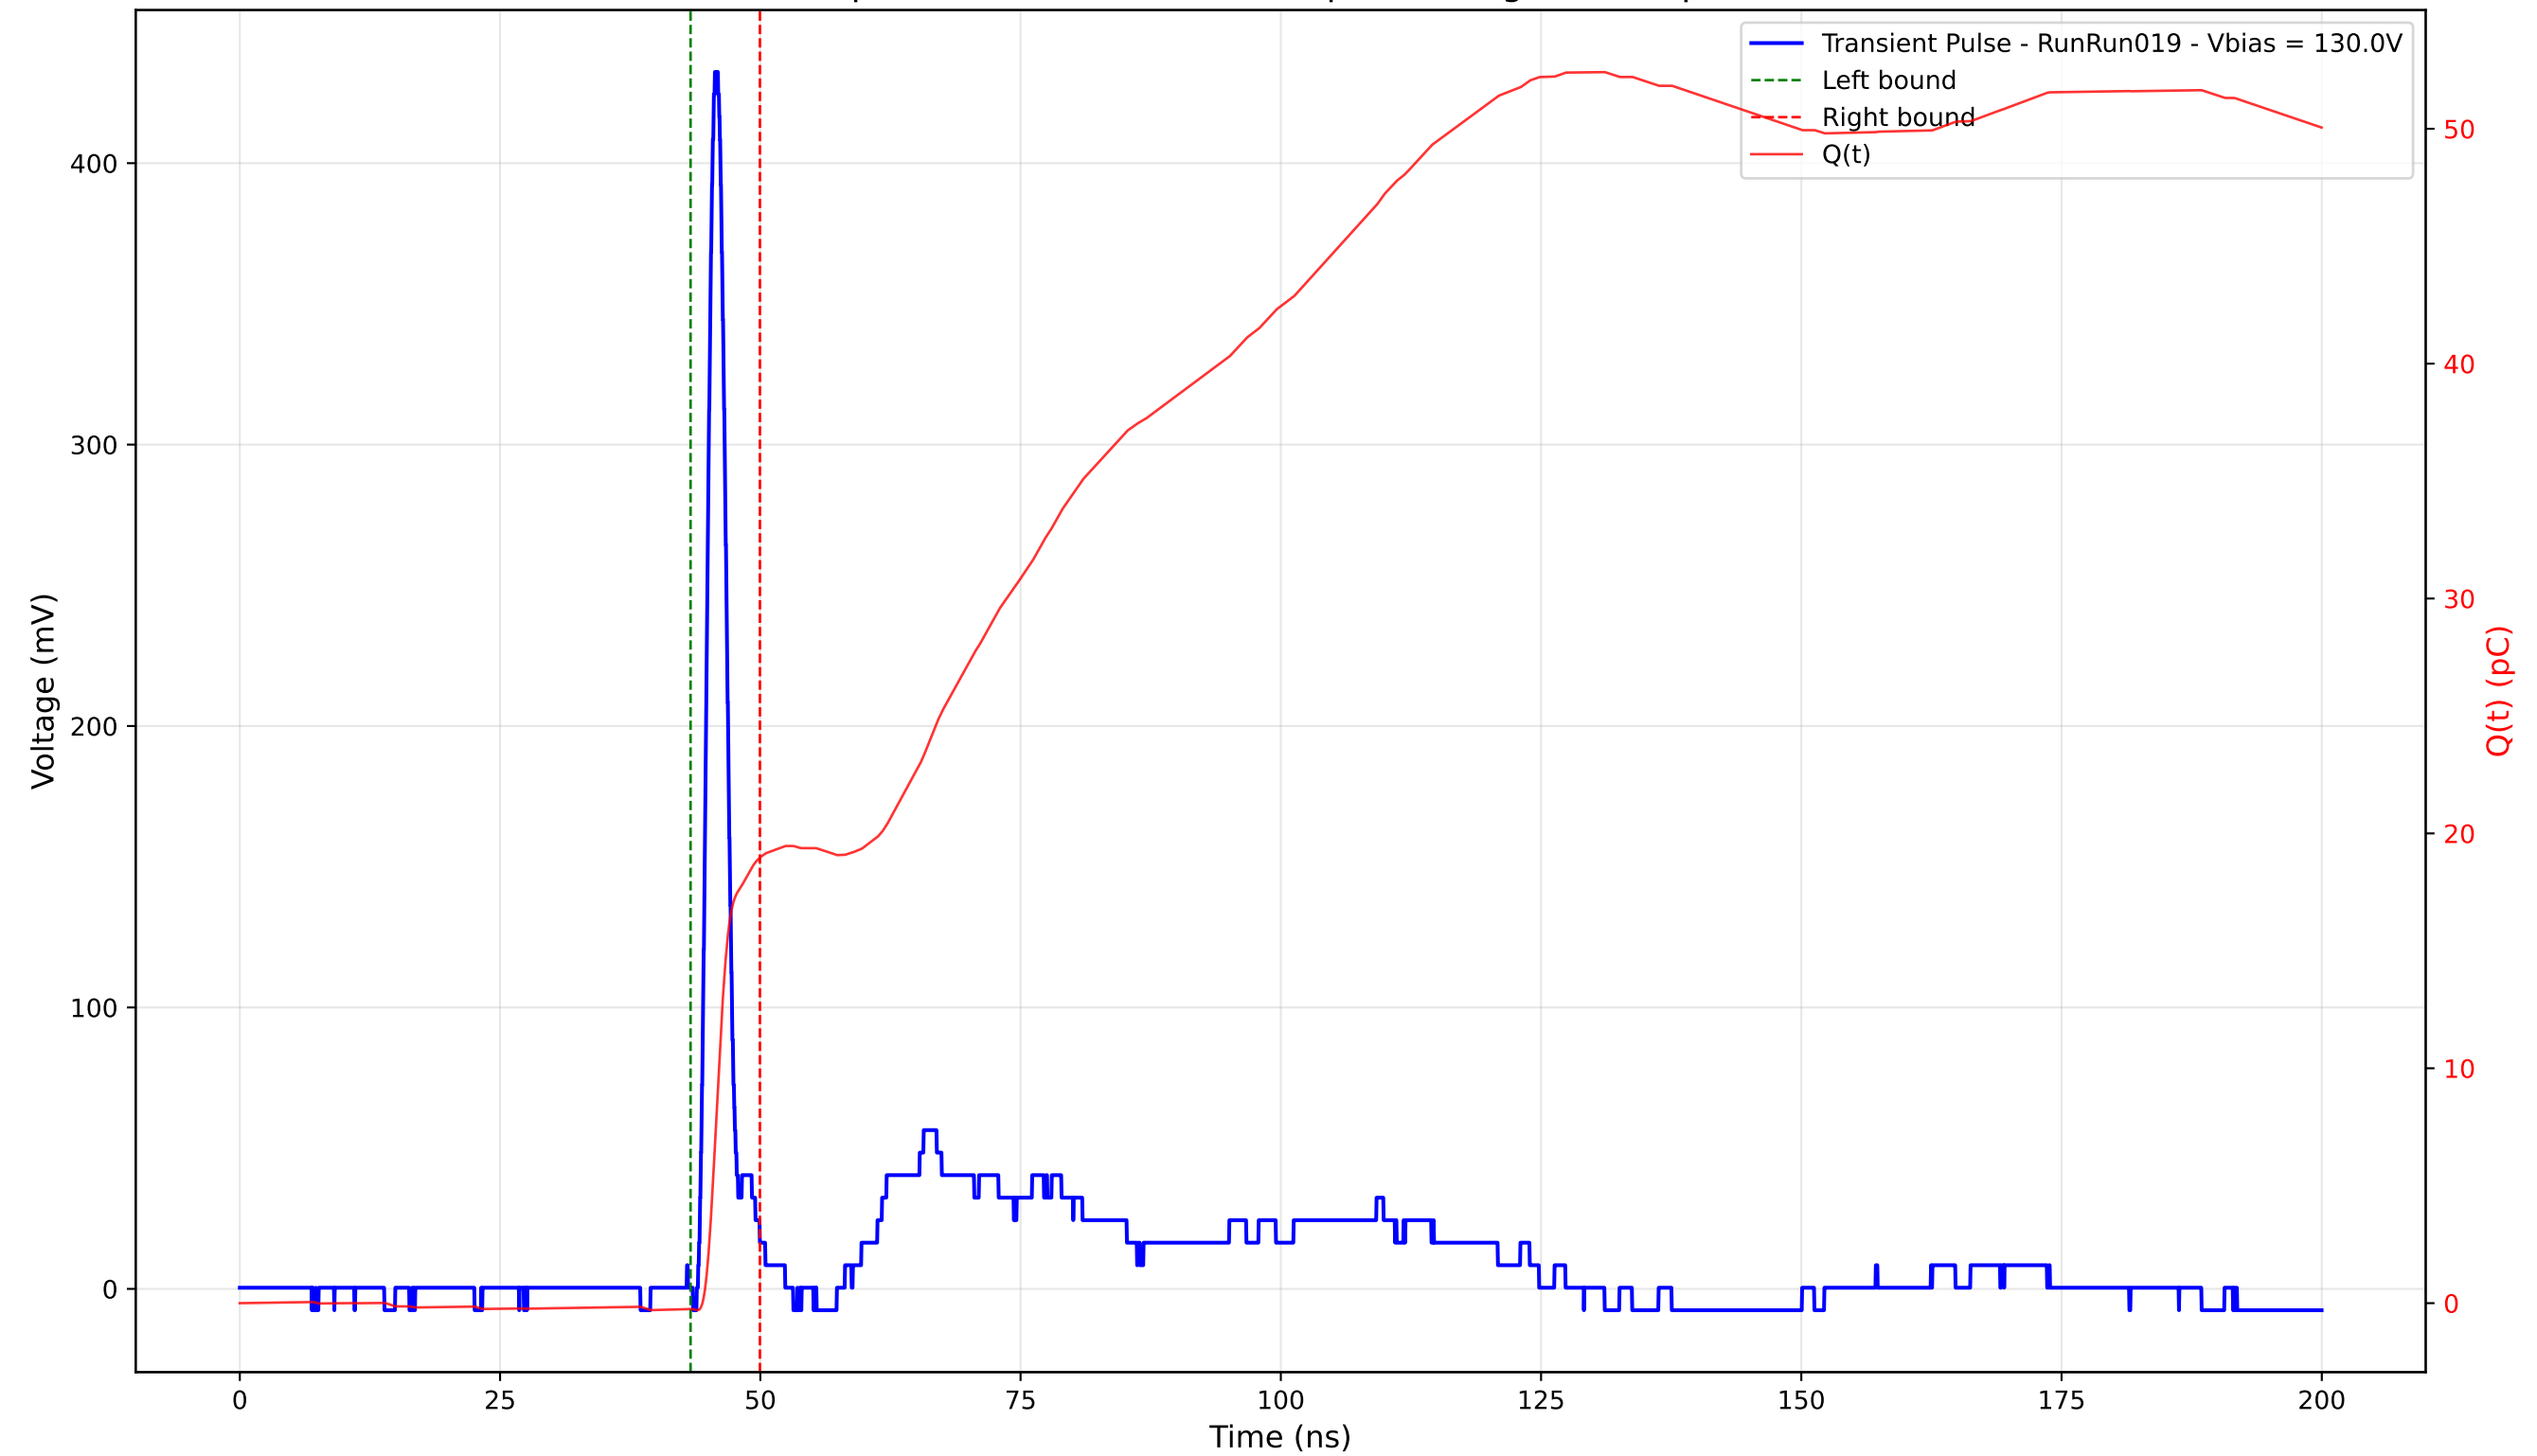


Transient Pulse - Sample: 4003 - Position: 195.0 μm - Charge: 19.17 pC - Rise Time: 1.09 ns

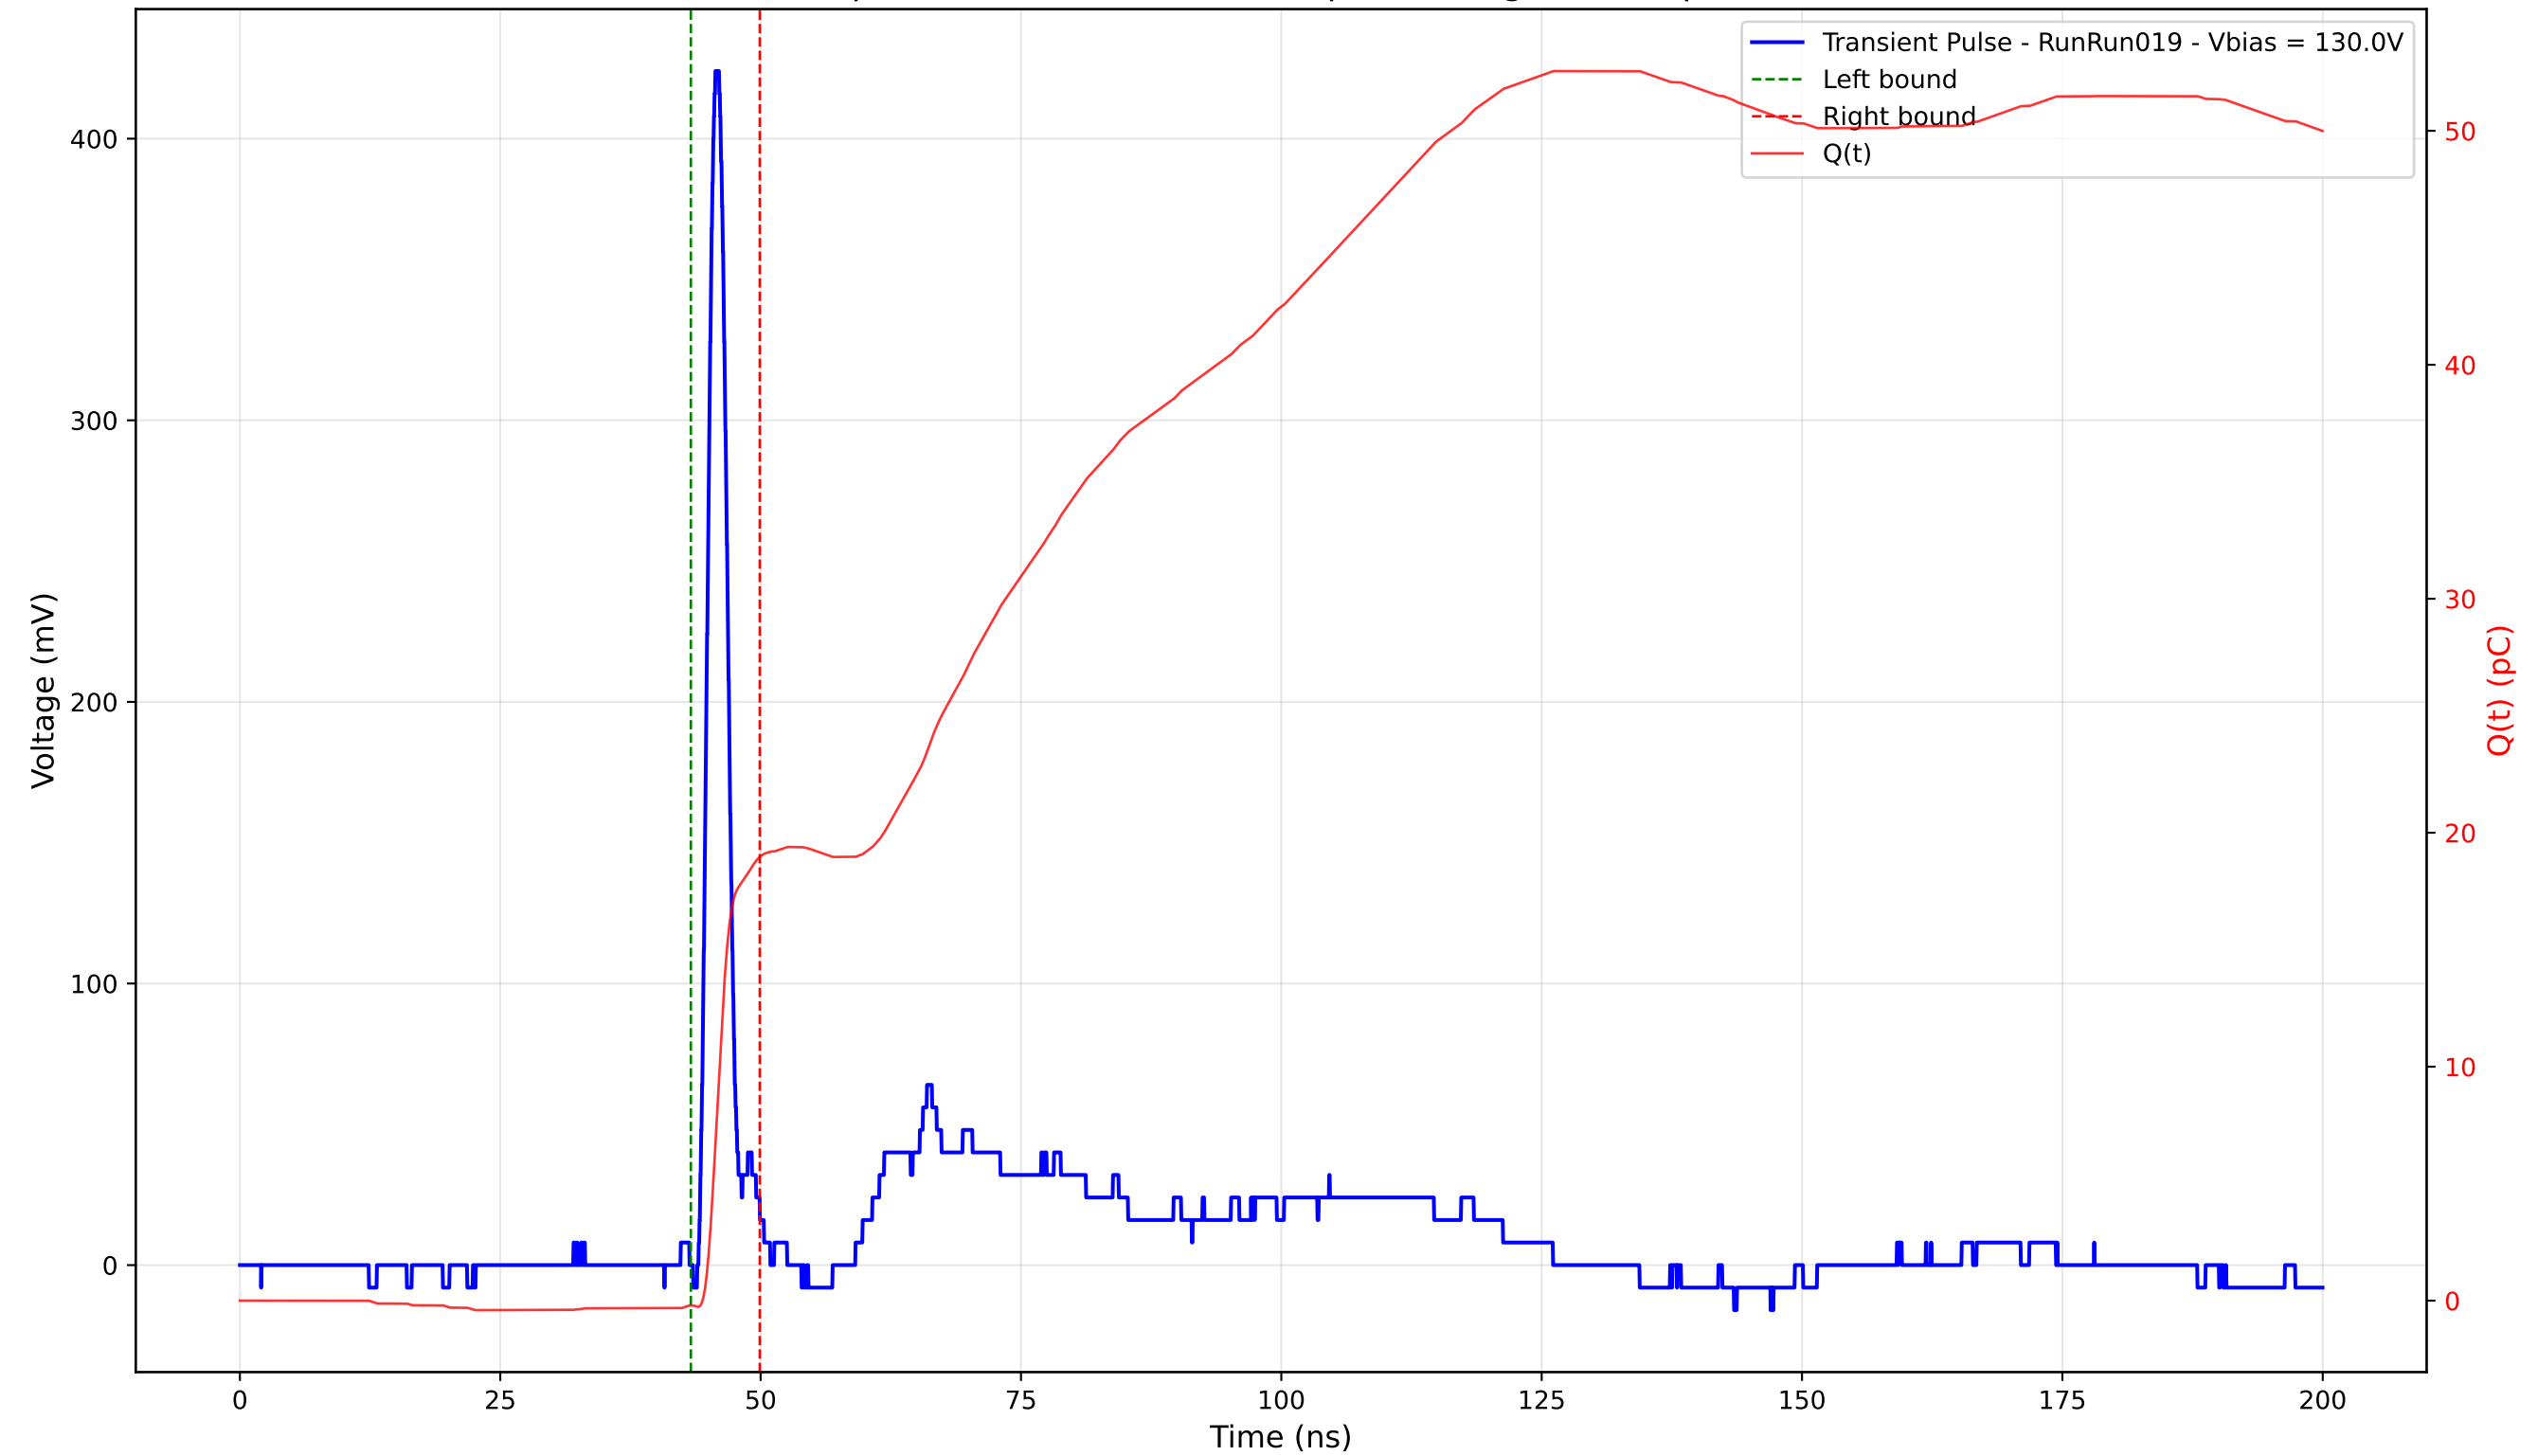


Transient Pulse - Sample: 4003 - Position: 200.0 μm - Charge: 19.36 pC - Rise Time: 1.10 ns

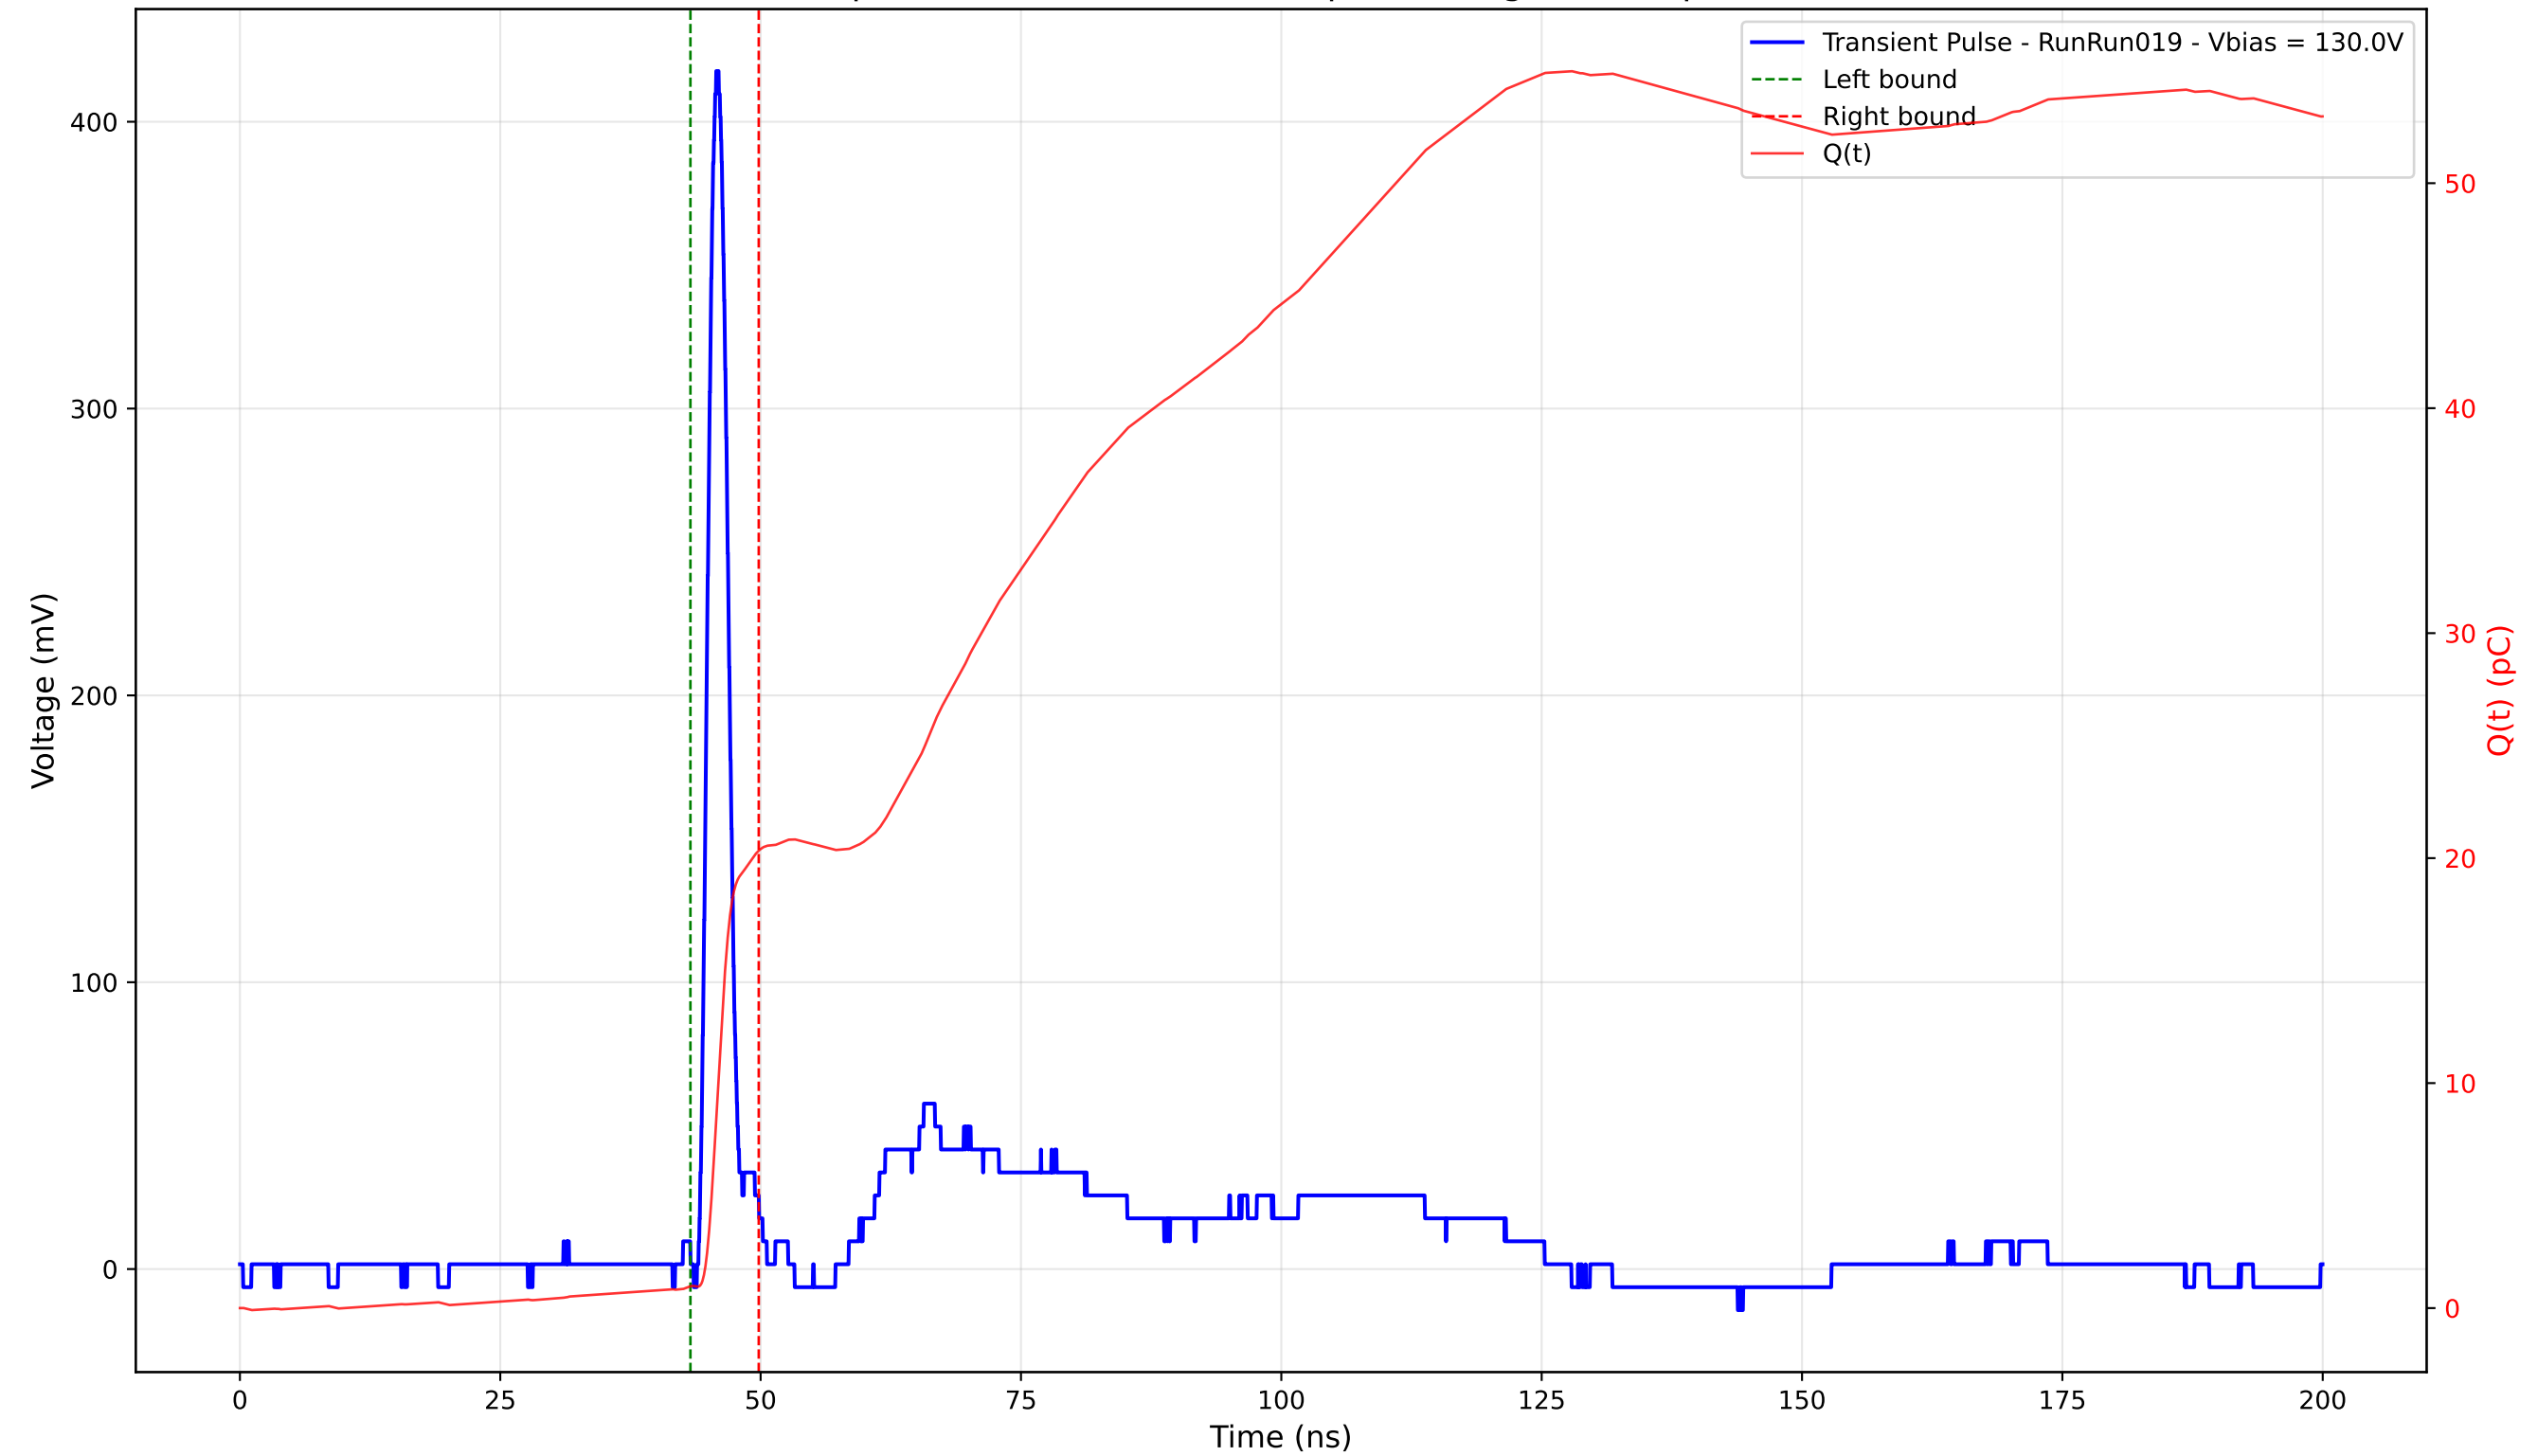


Transient Pulse - Sample: 4003 - Position: 205.0 μm - Charge: 19.37 pC - Rise Time: 1.11 ns

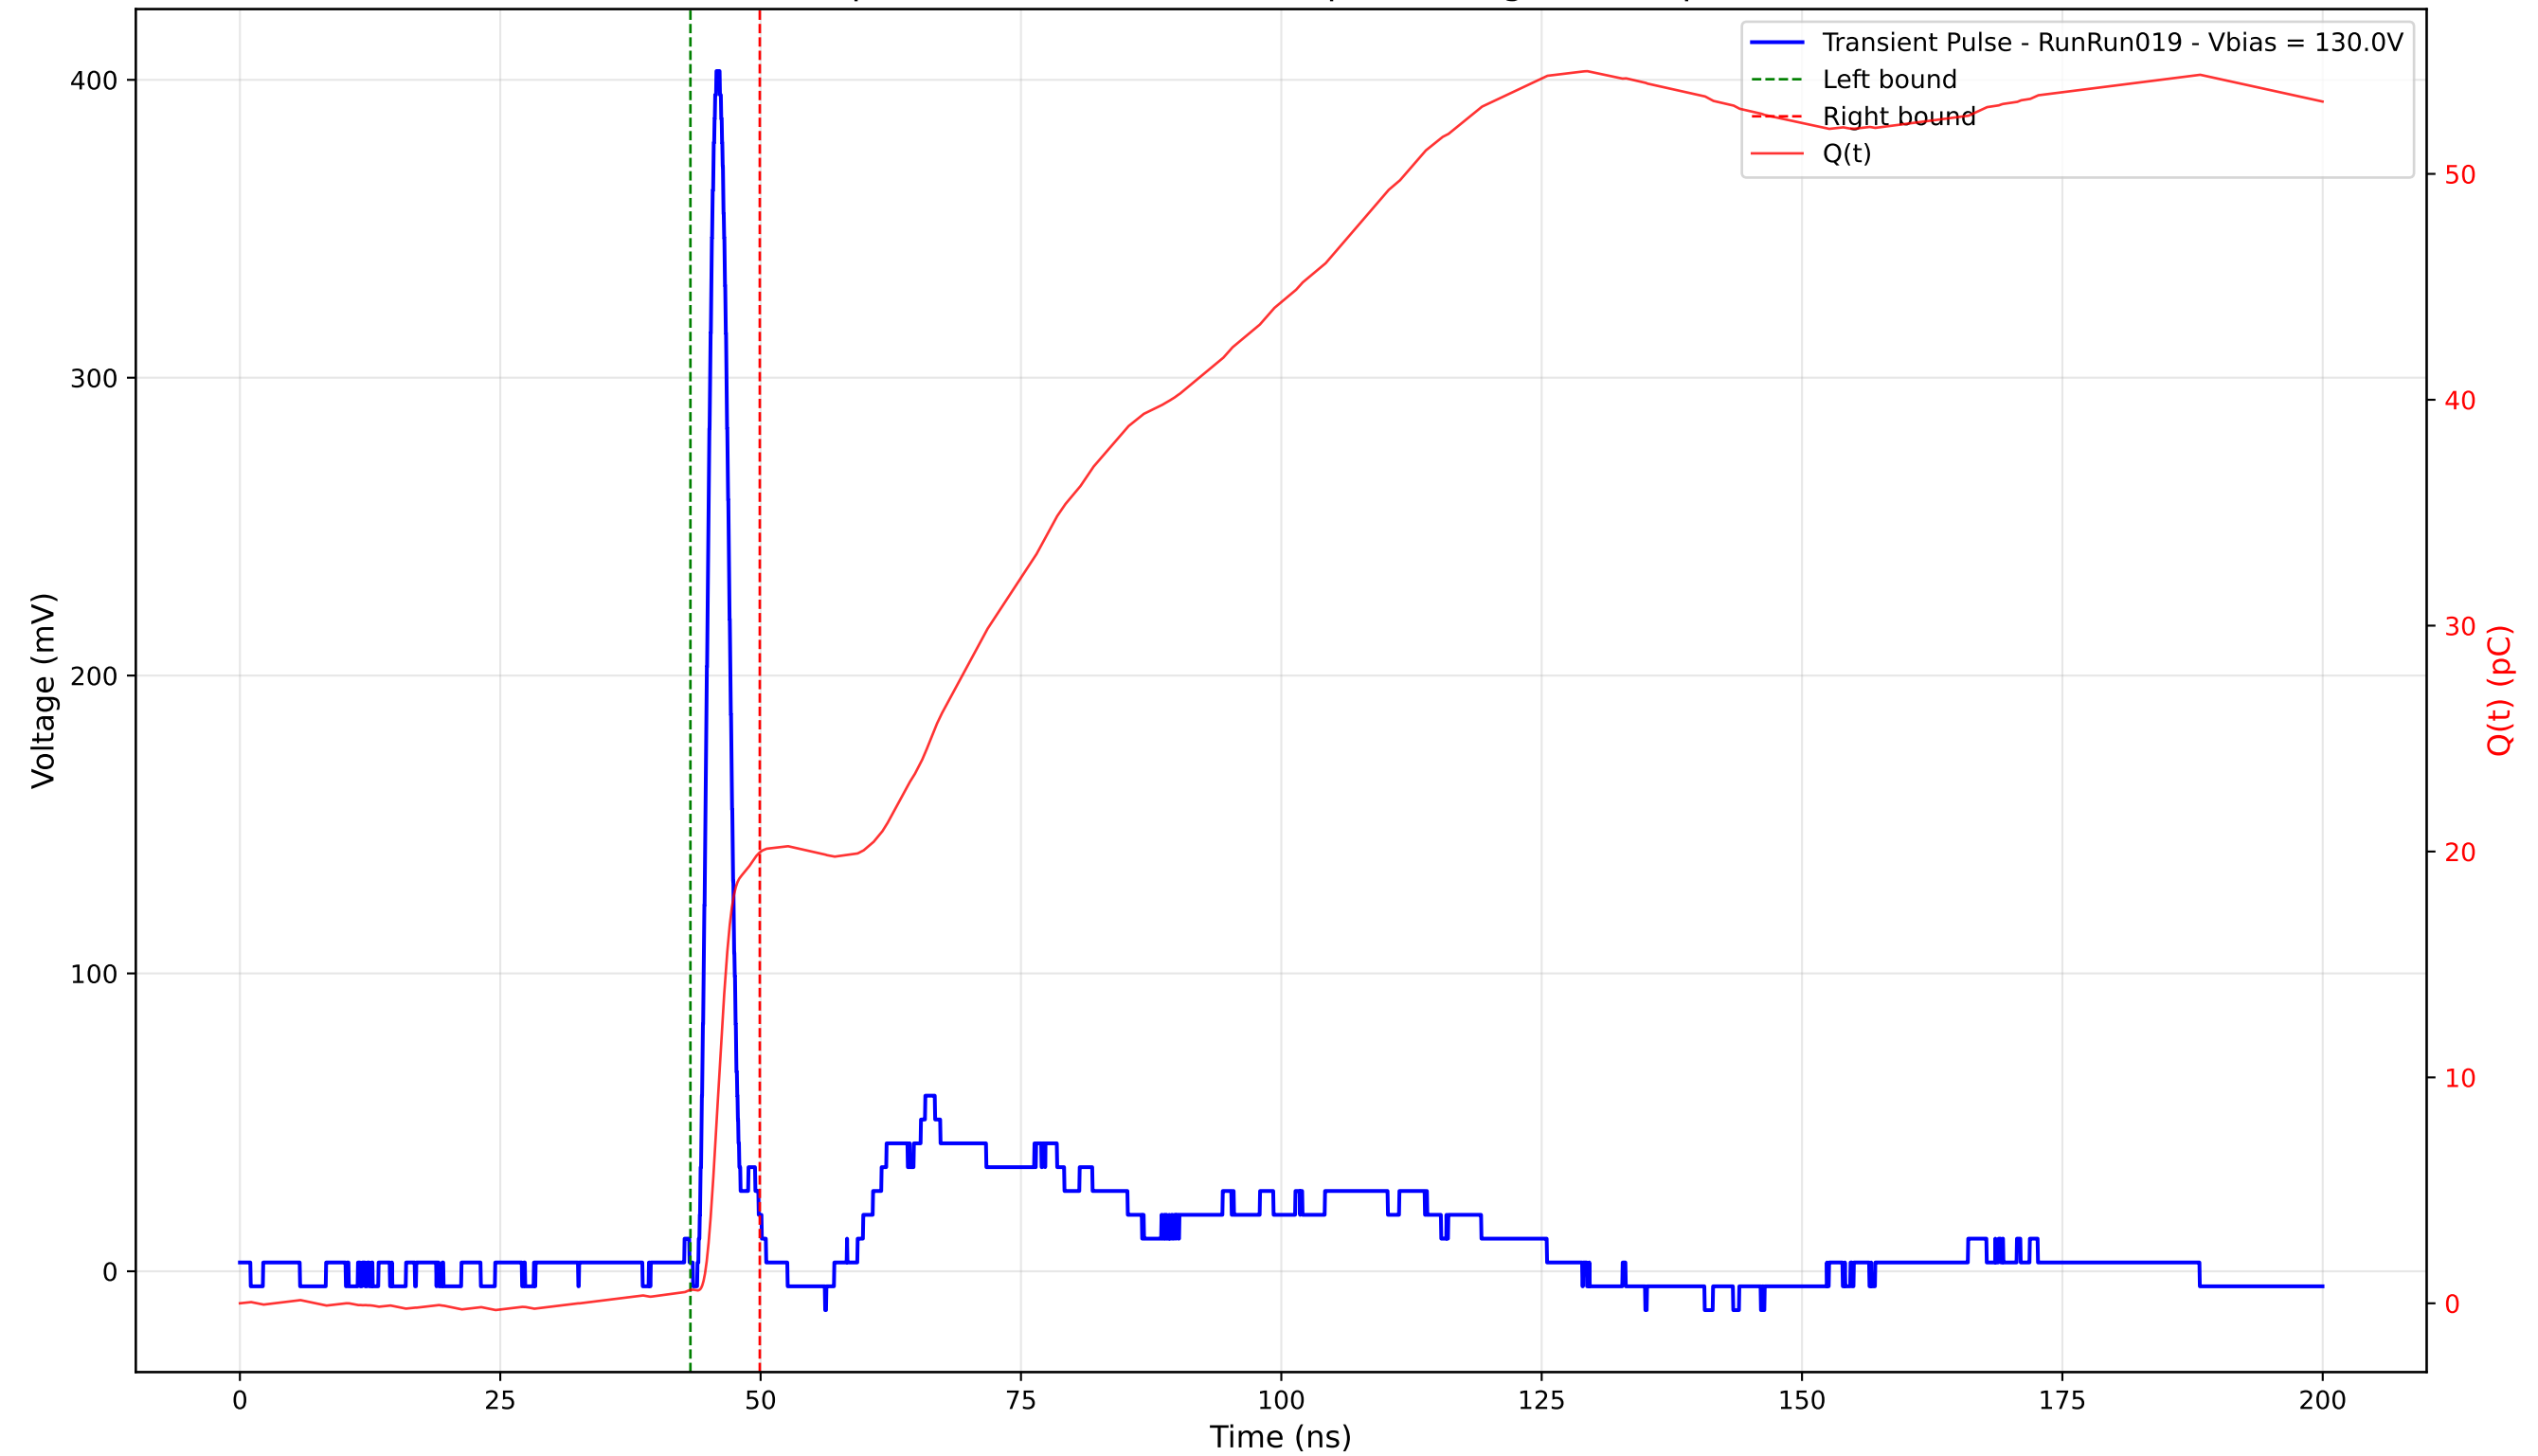


Transient Pulse - Sample: 4003 - Position: 210.0 μm - Charge: 18.94 pC - Rise Time: 1.14 ns

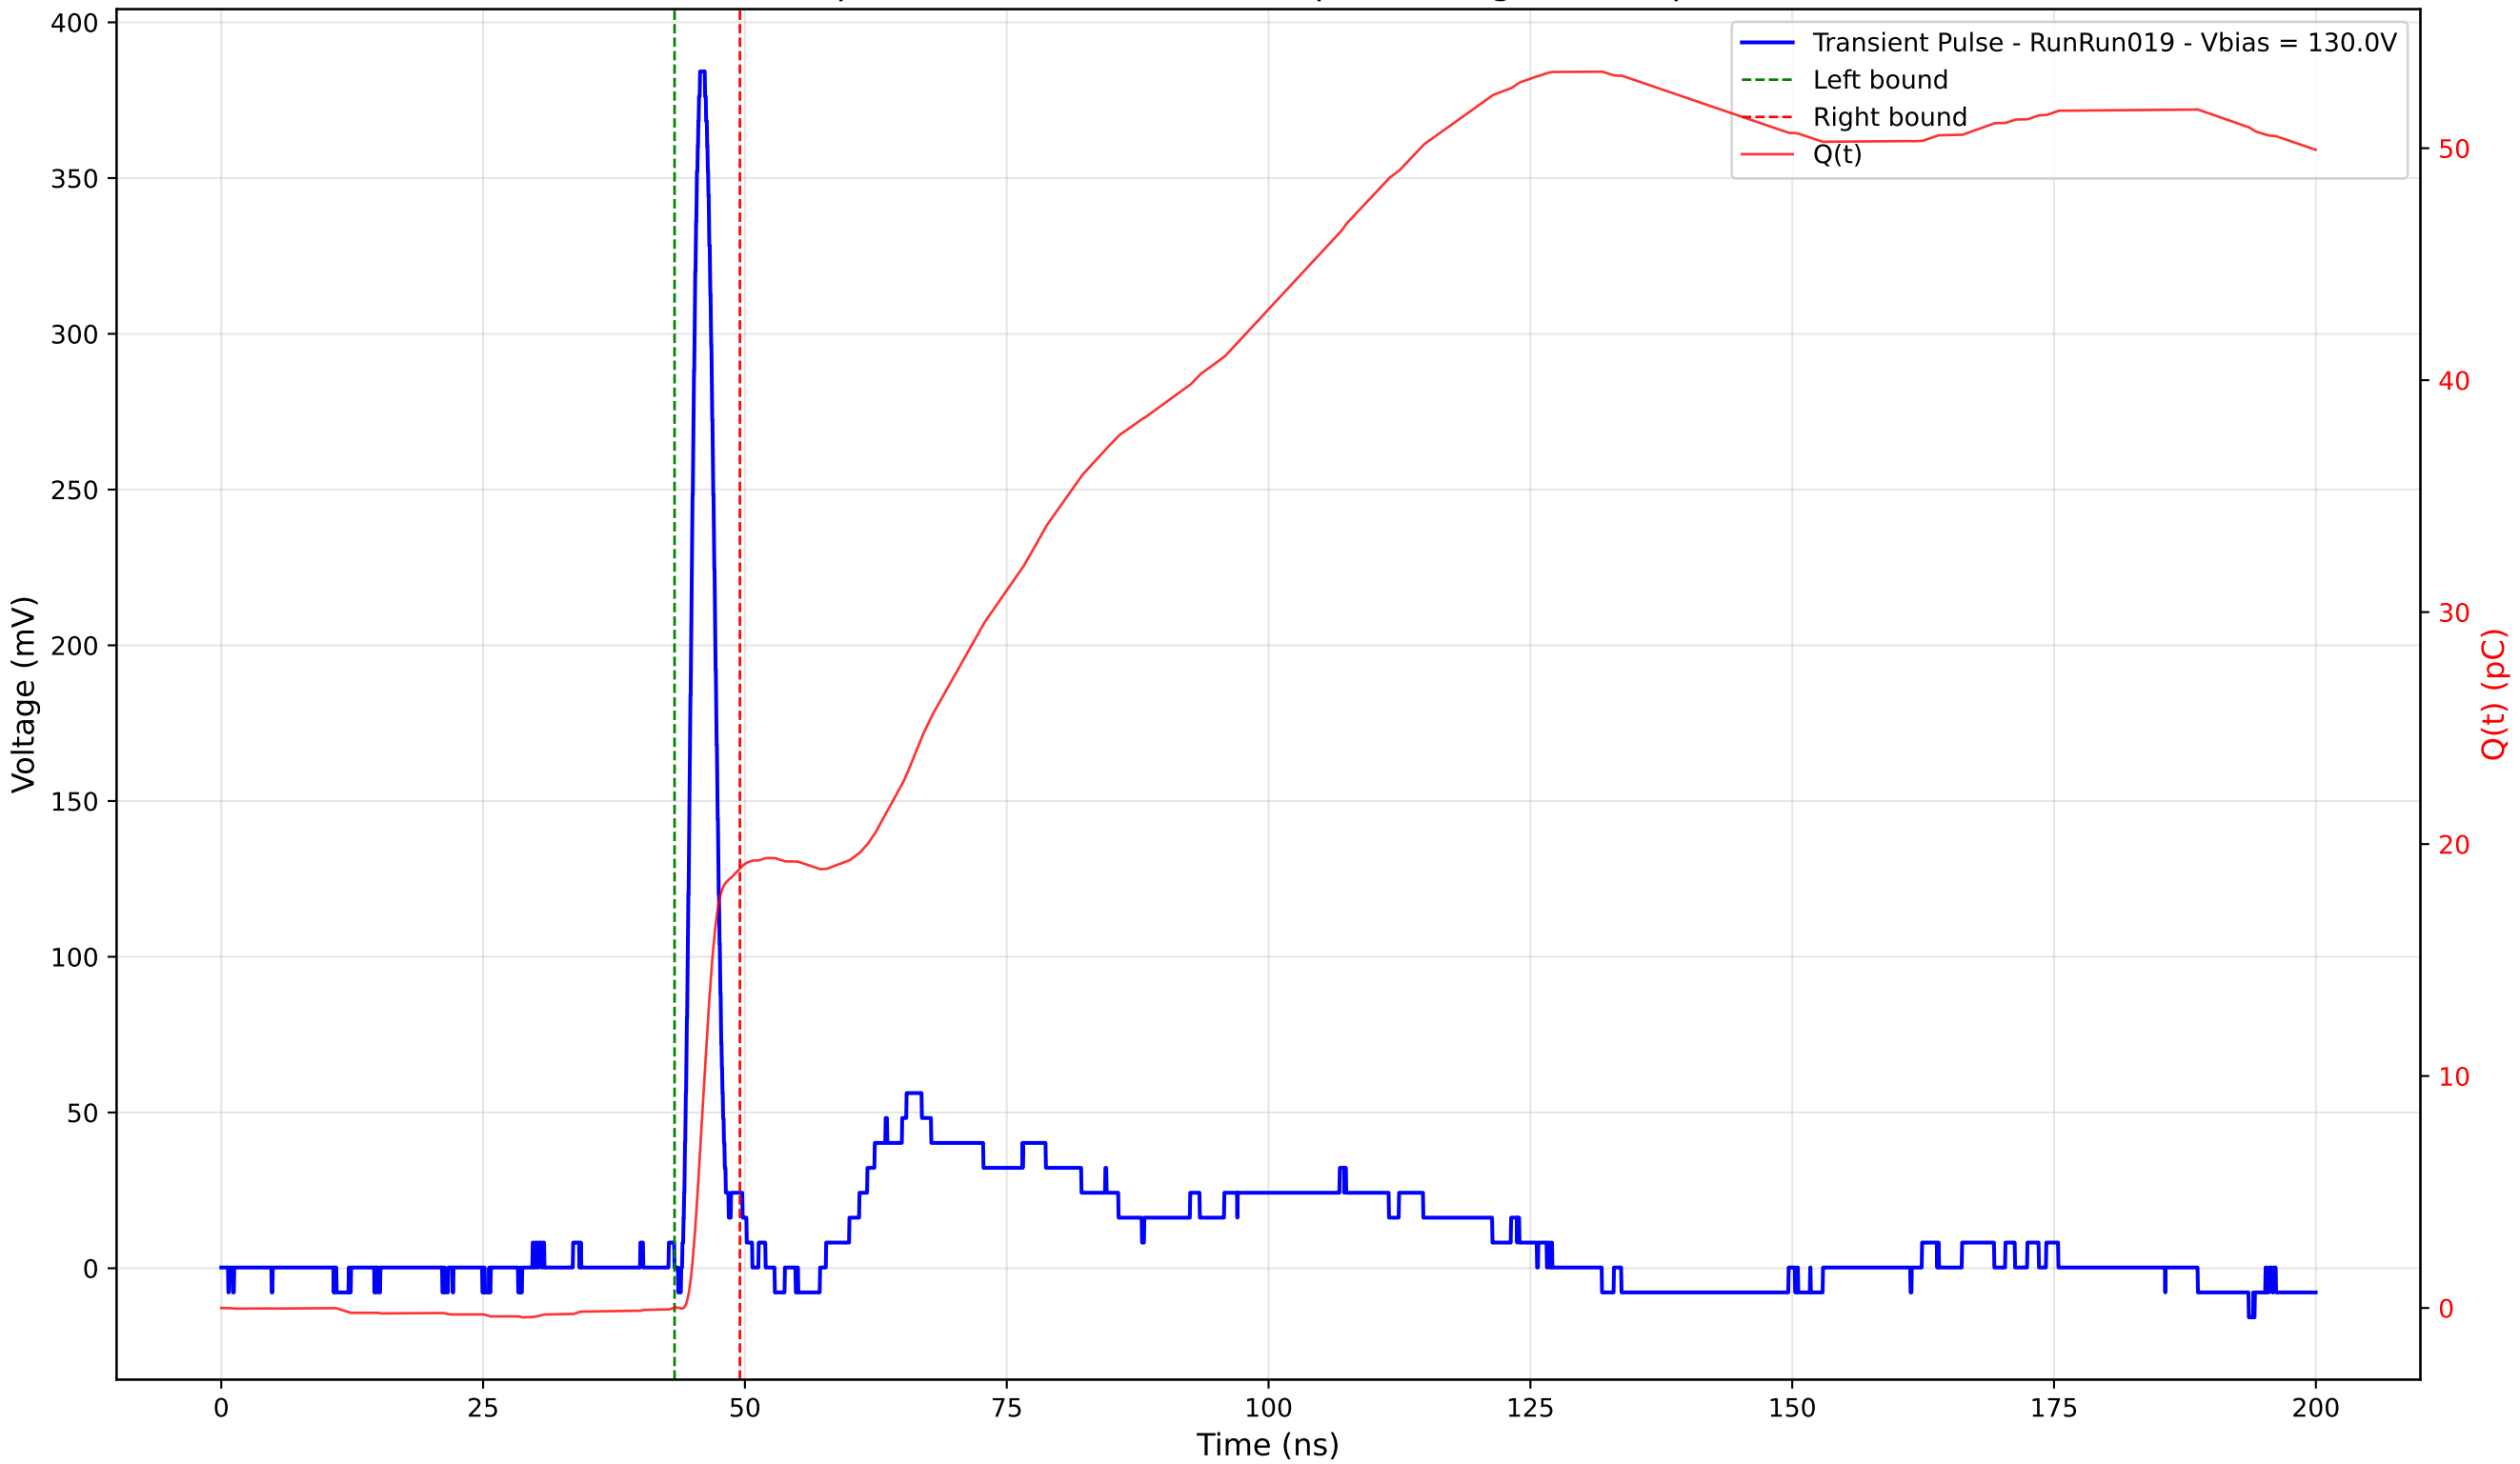


Transient Pulse - Sample: 4003 - Position: 215.0 μm - Charge: 18.76 pC - Rise Time: 1.14 ns

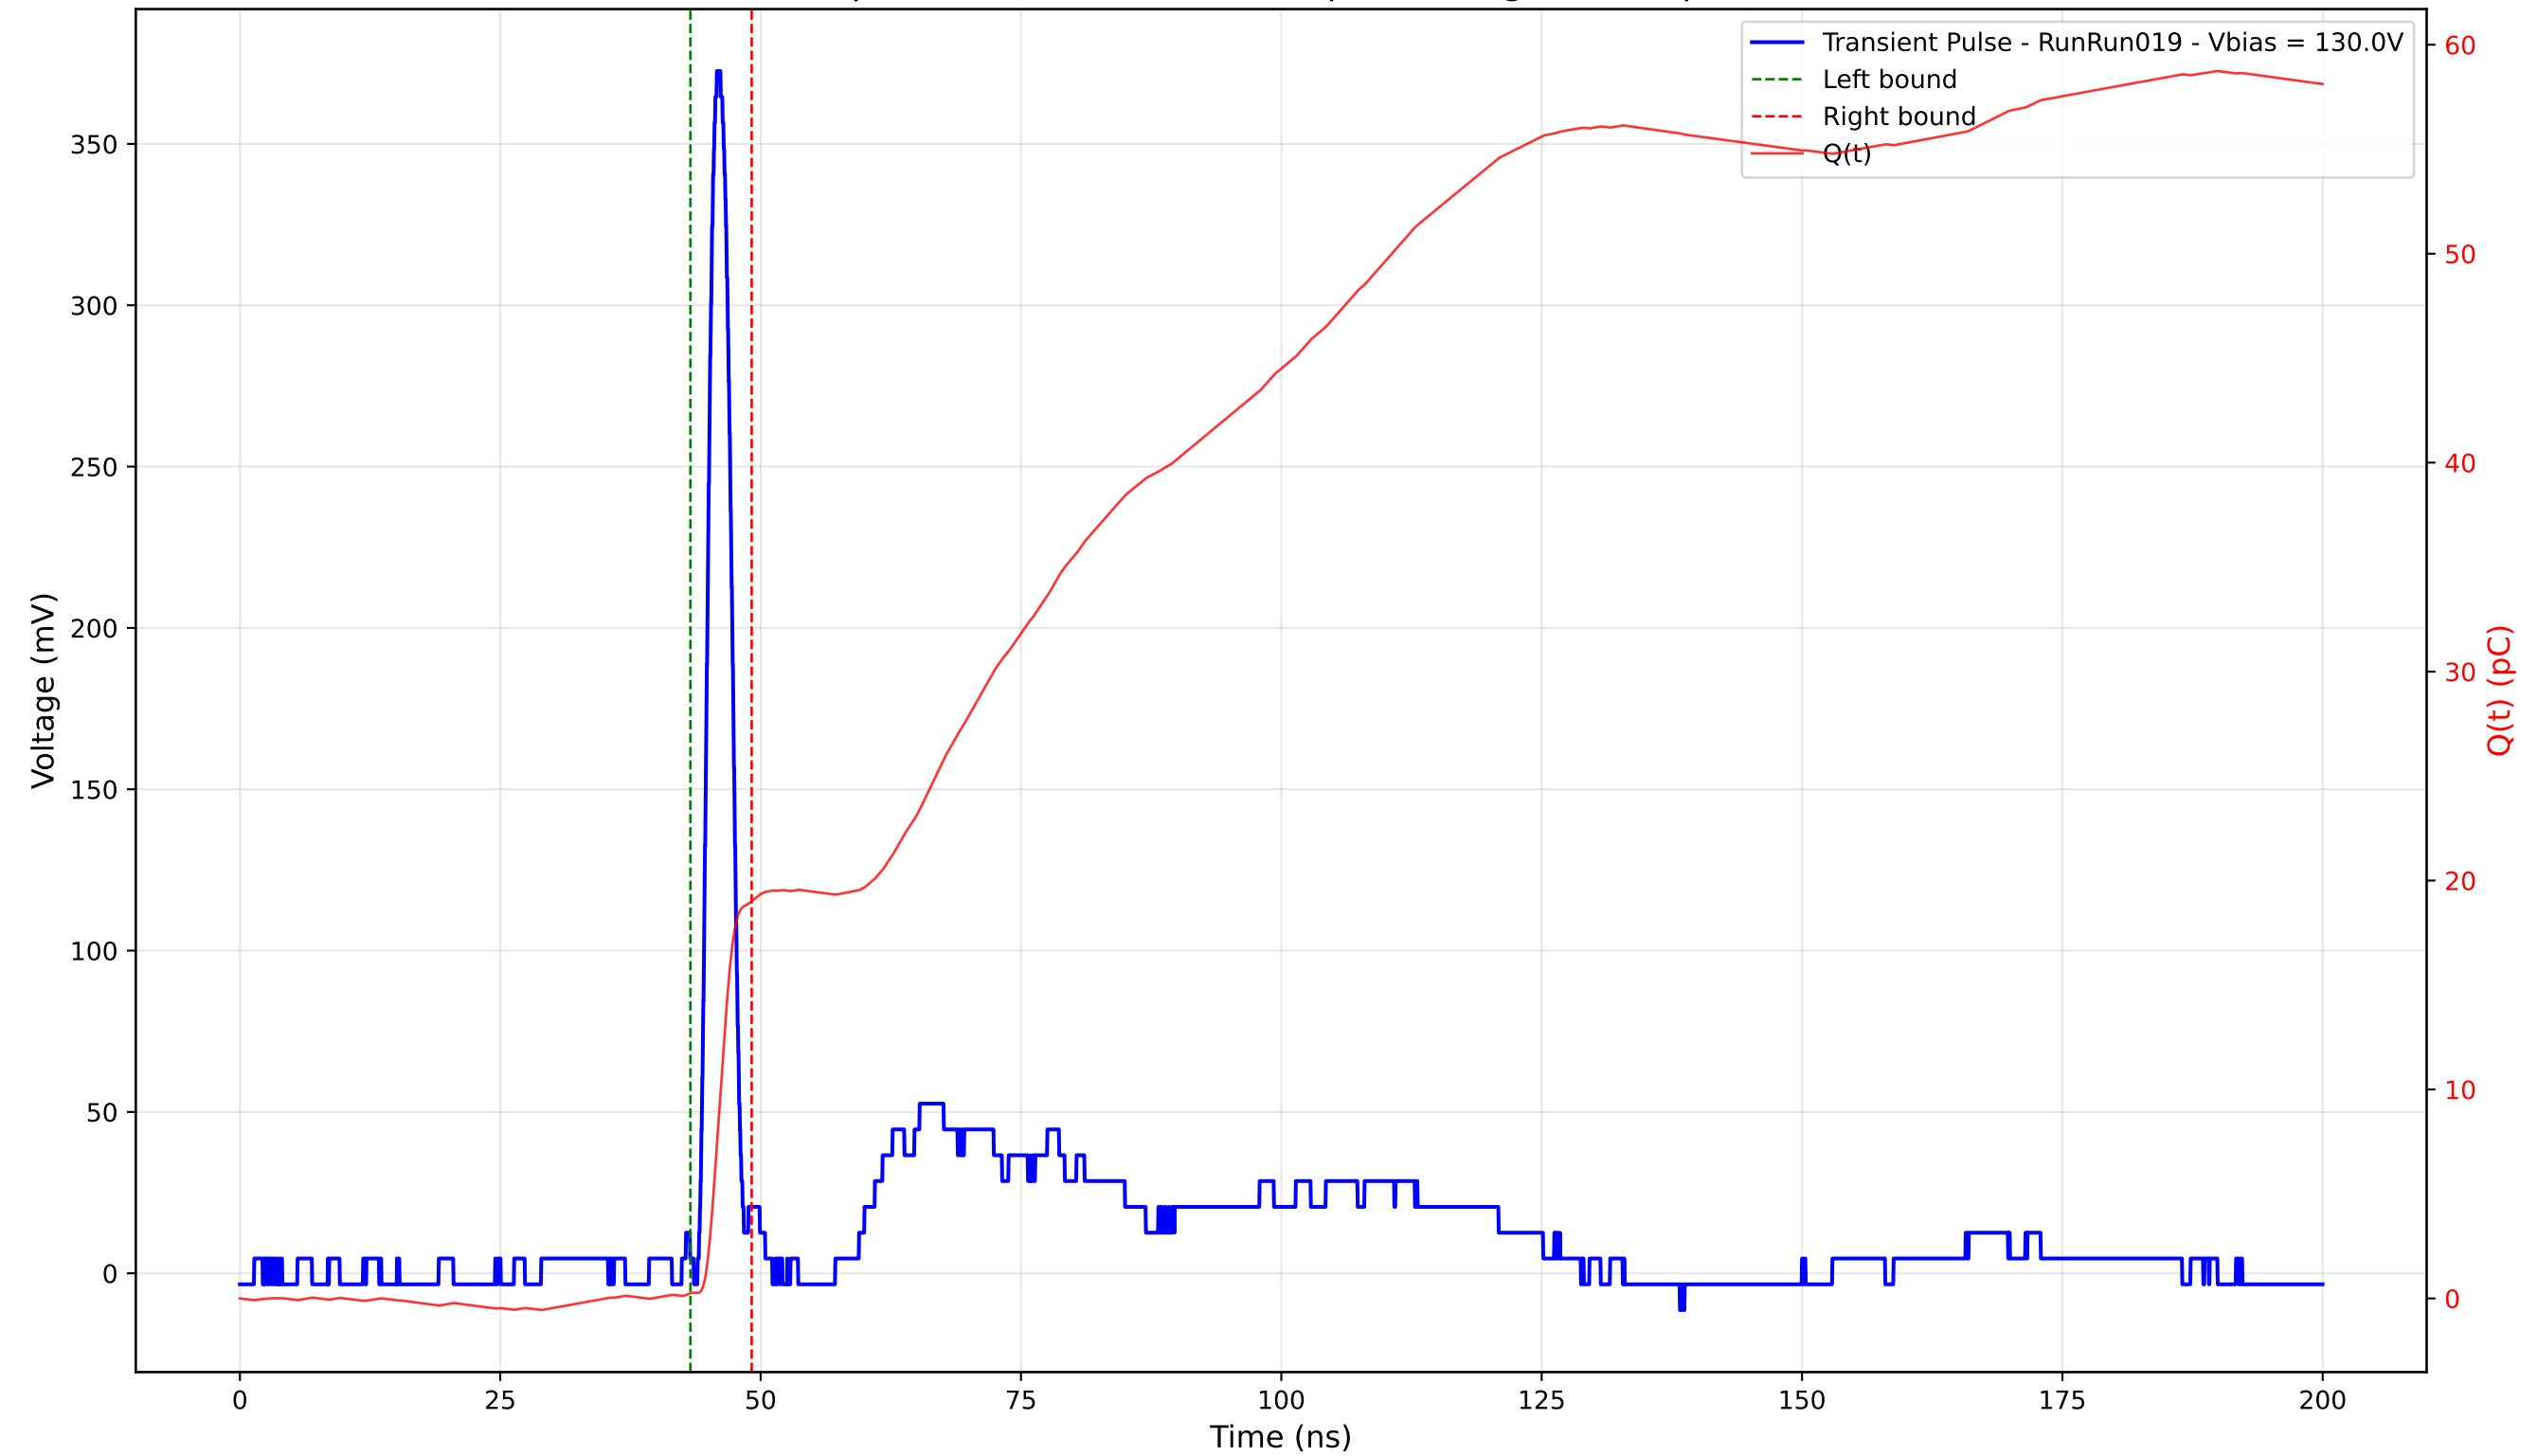


Transient Pulse - Sample: 4003 - Position: 220.0 μm - Charge: 18.61 pC - Rise Time: 1.16 ns

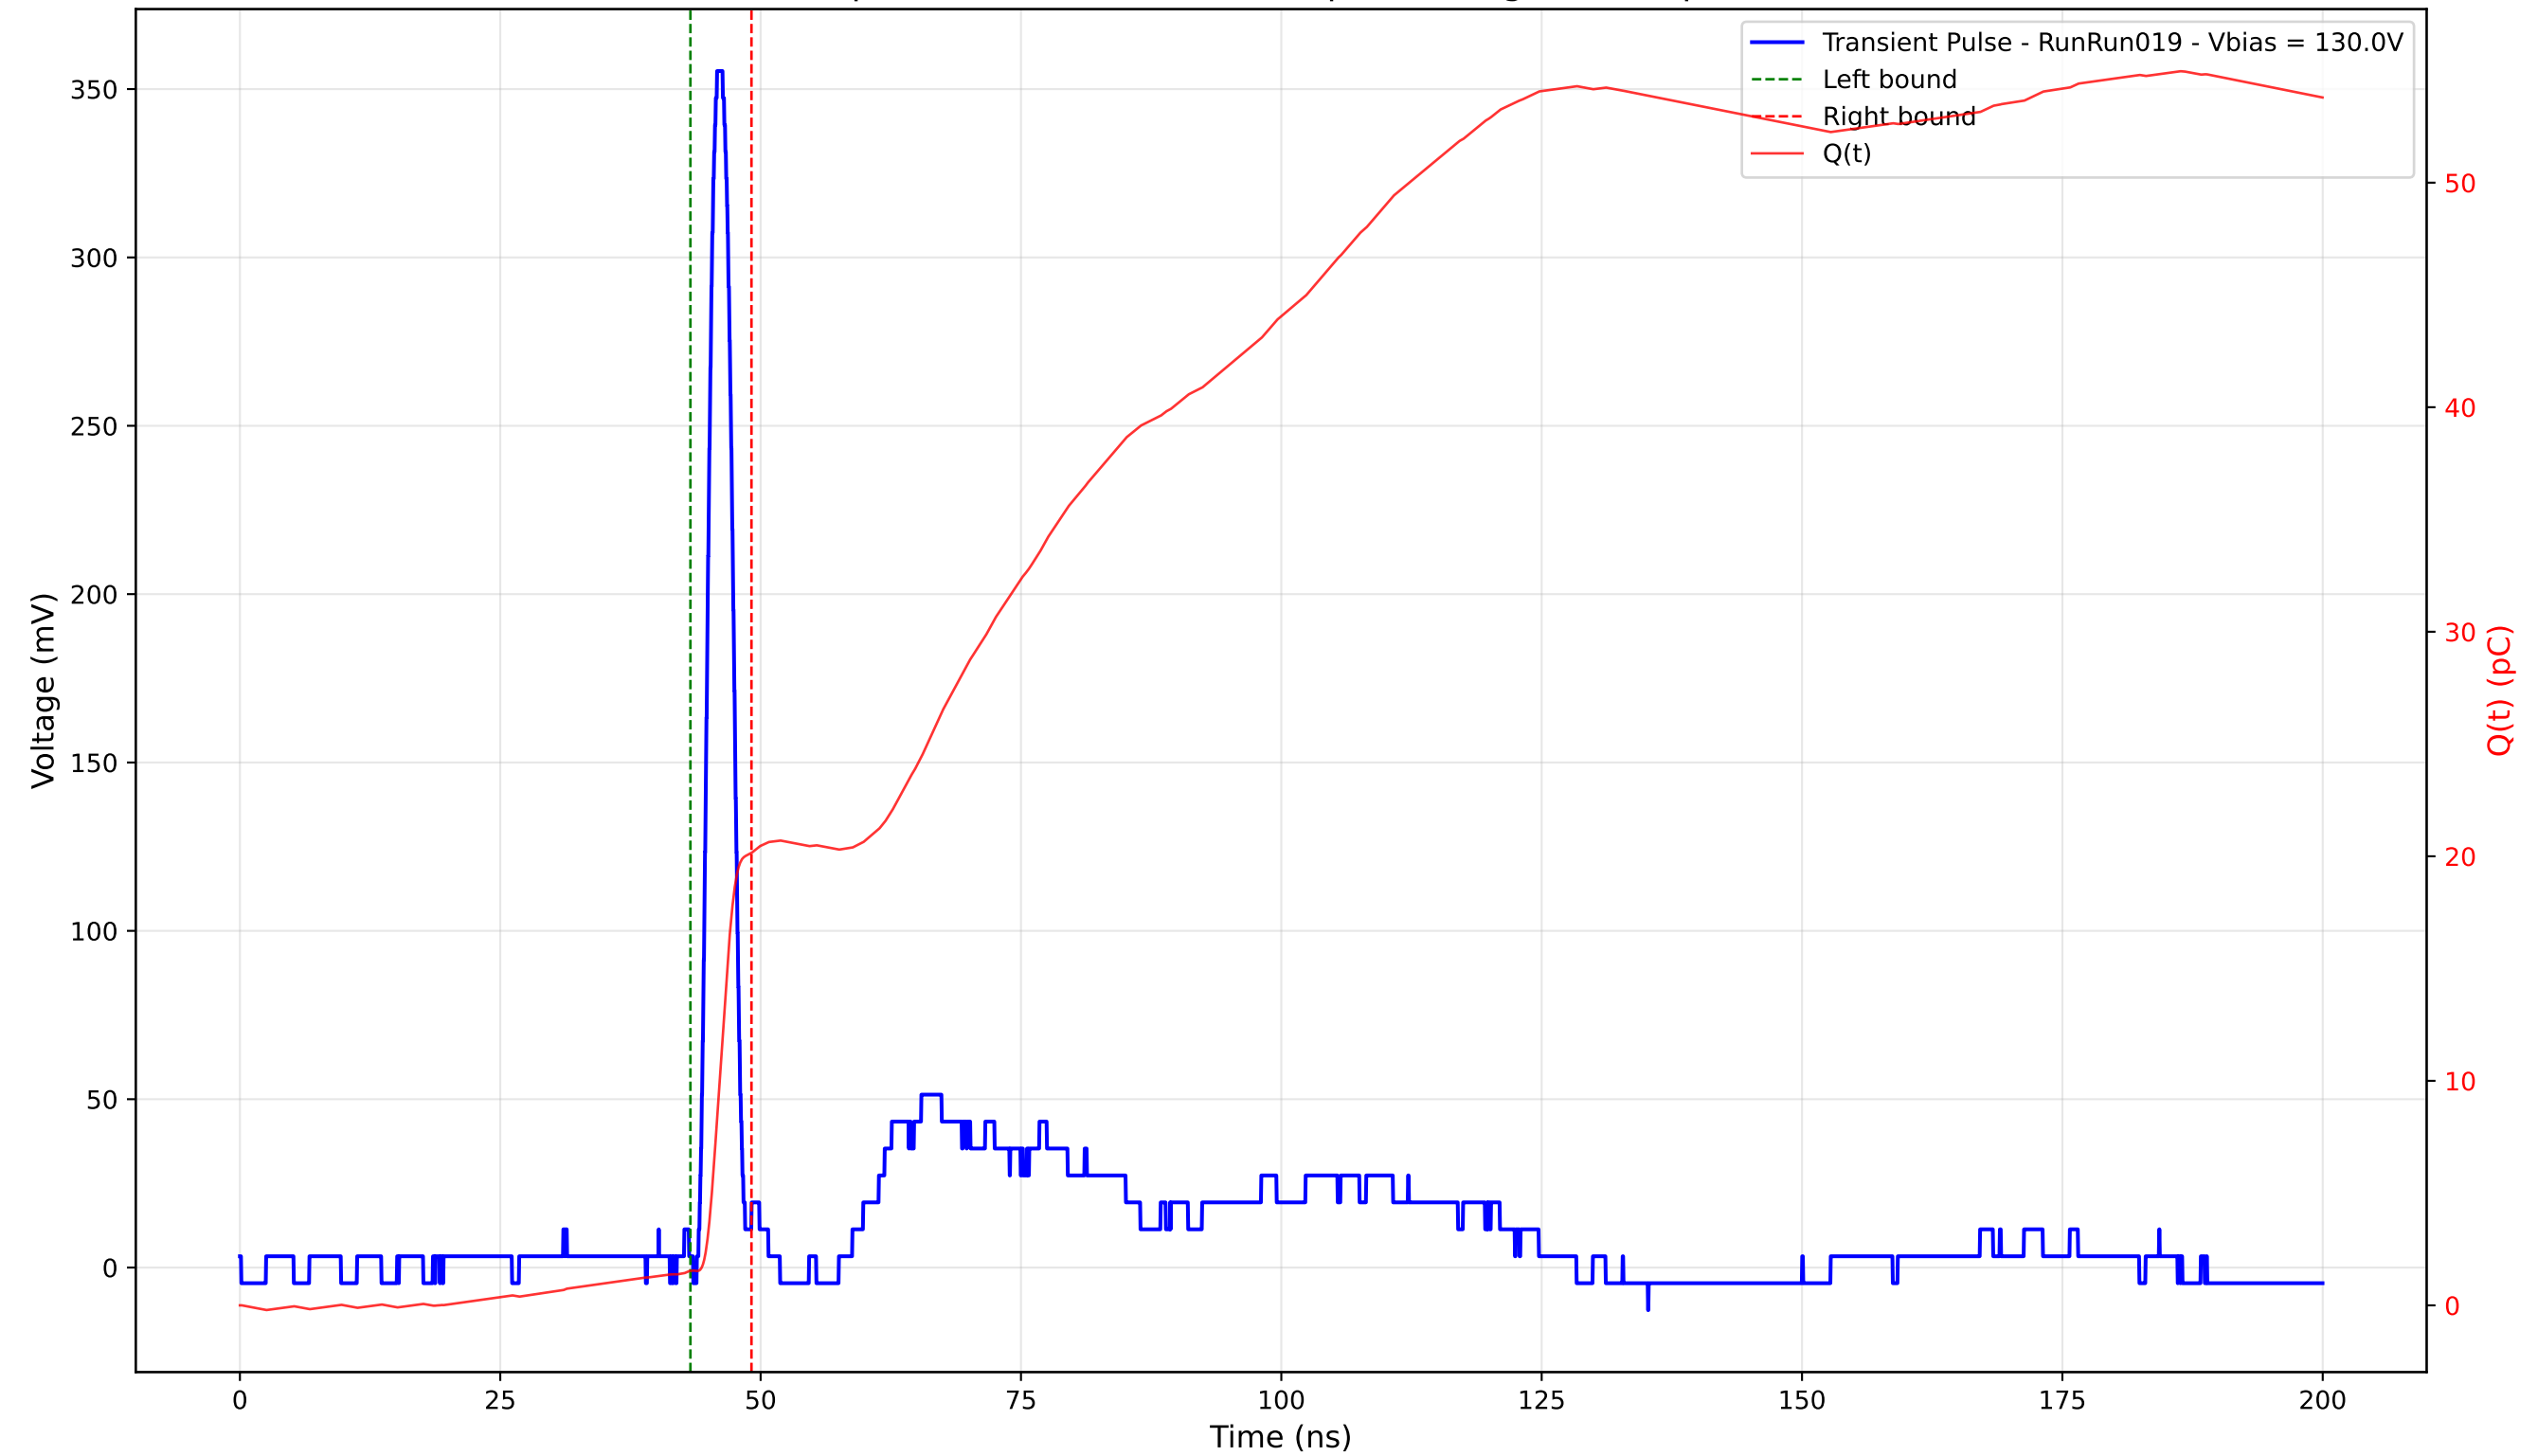


Transient Pulse - Sample: 4003 - Position: 225.0 μm - Charge: 18.41 pC - Rise Time: 1.16 ns

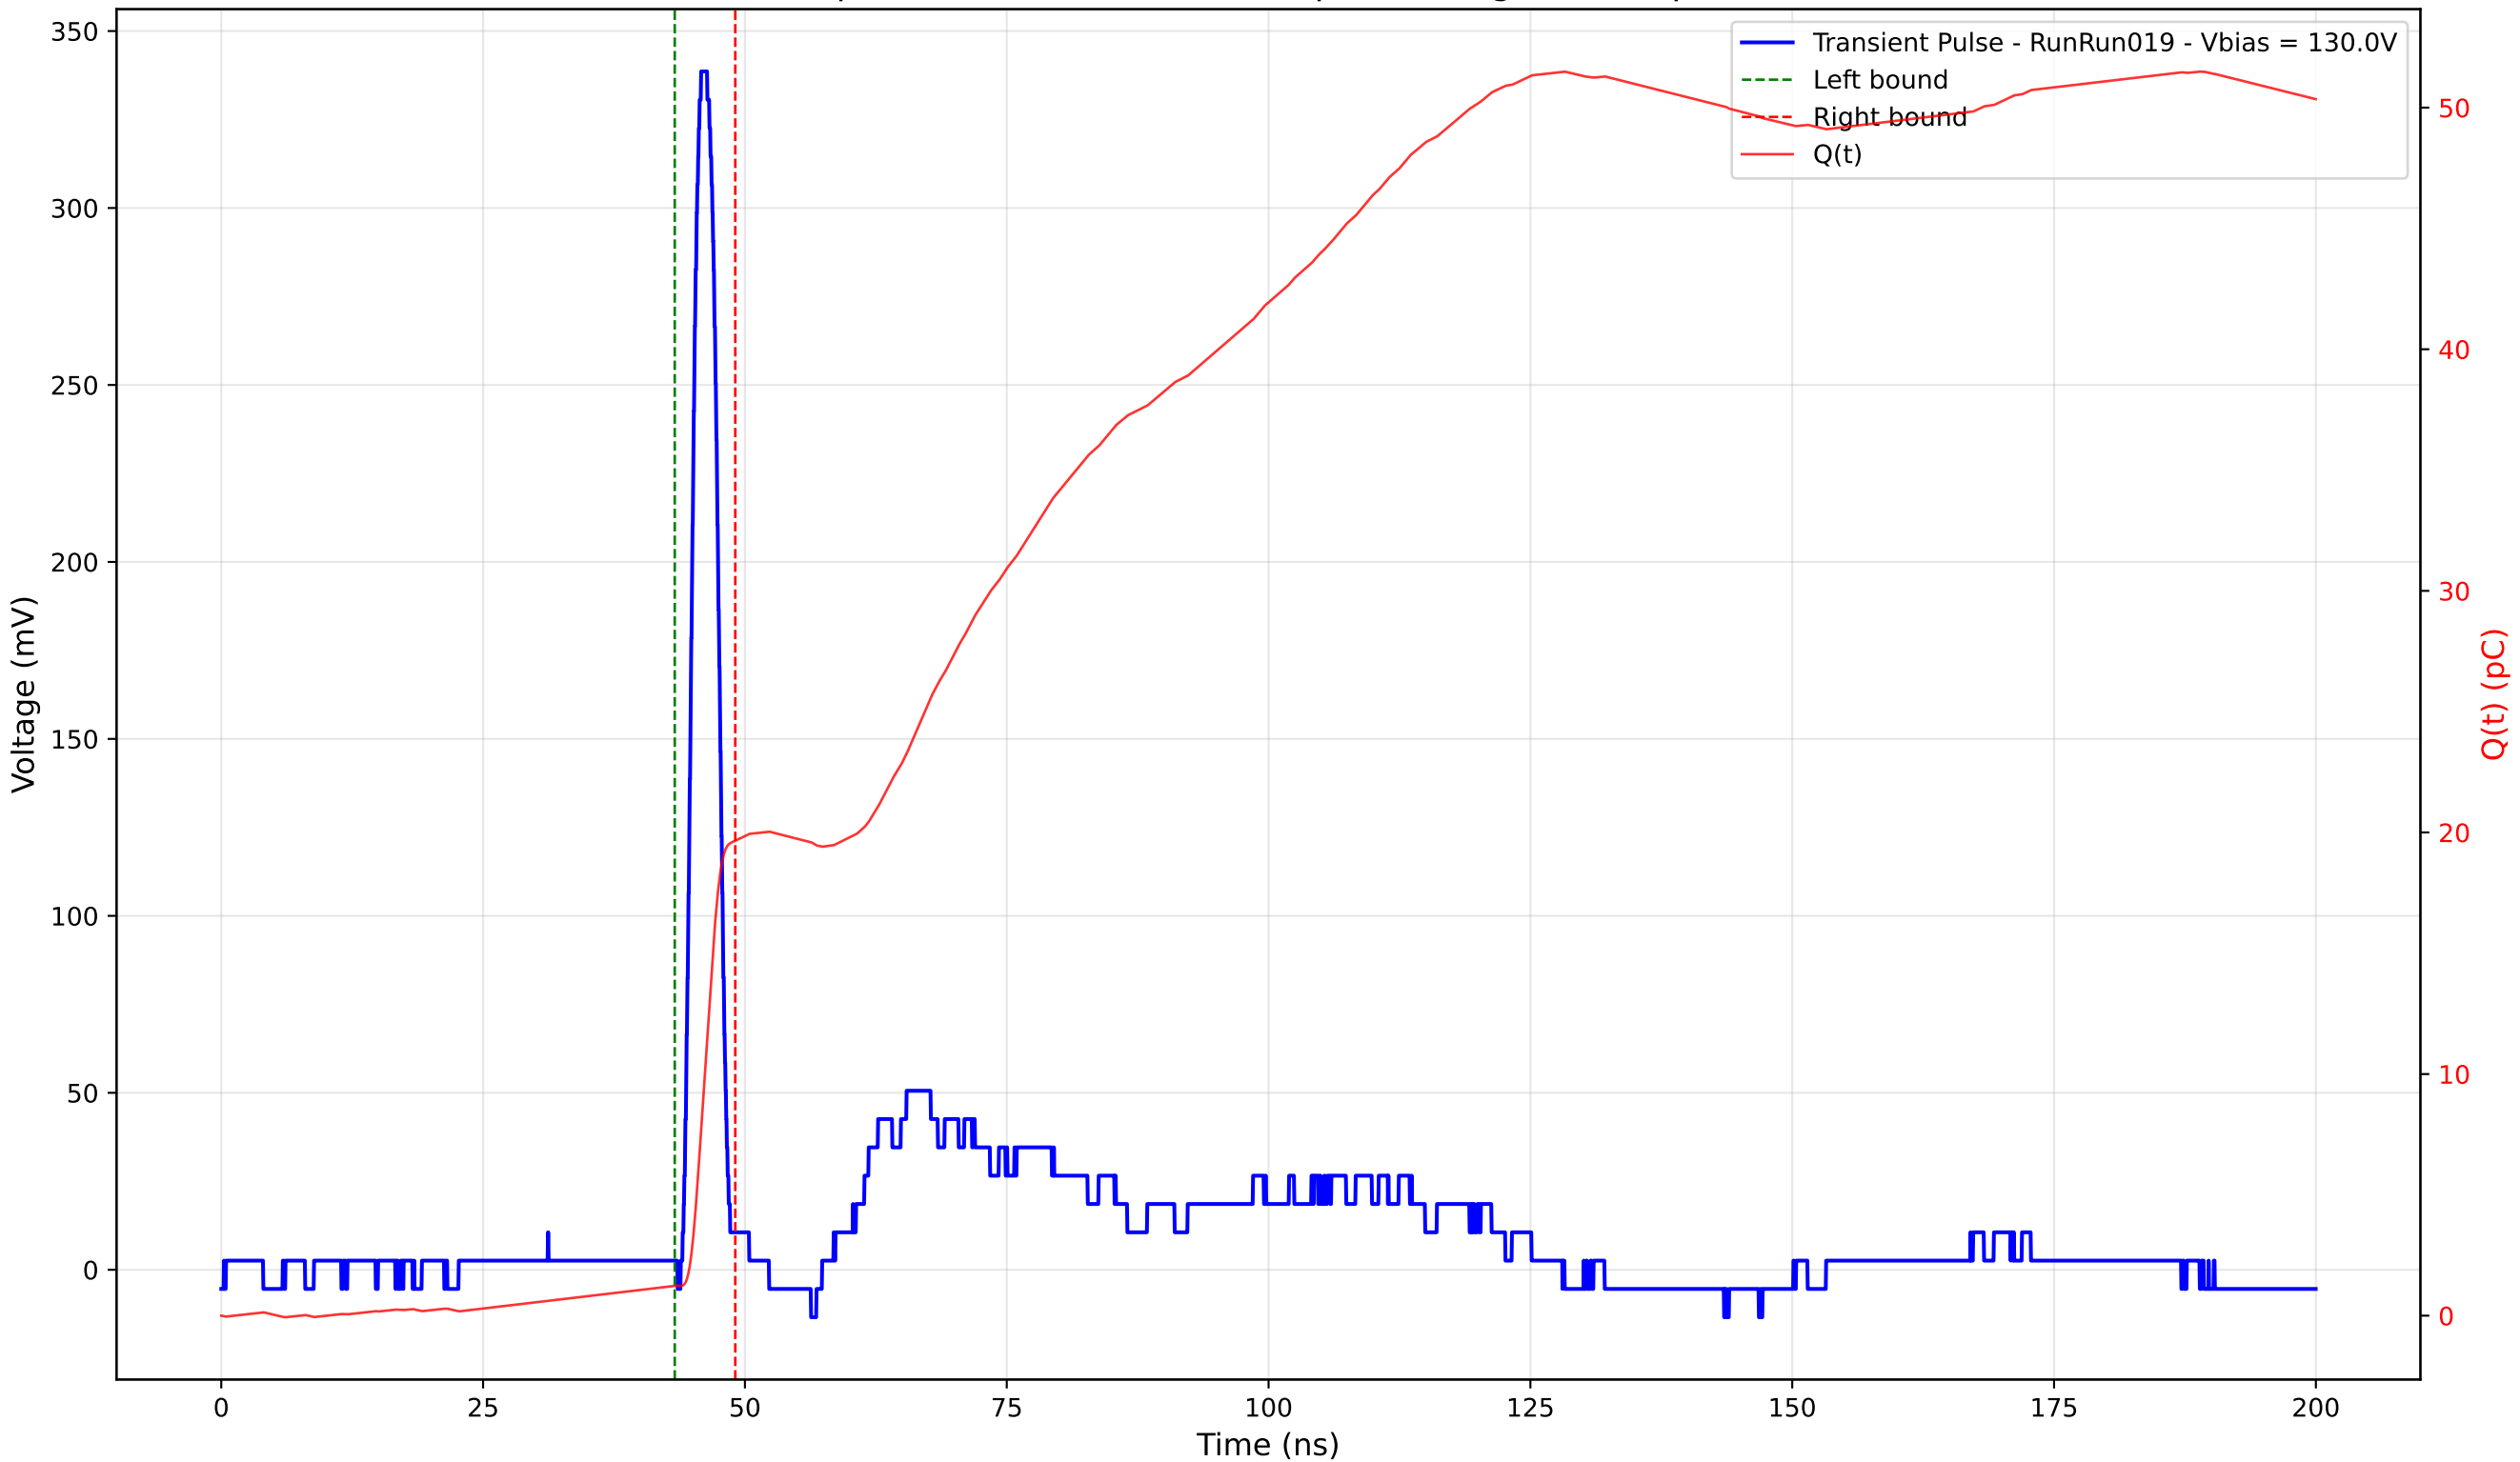


Transient Pulse - Sample: 4003 - Position: 230.0 μm - Charge: 18.22 pC - Rise Time: 1.21 ns

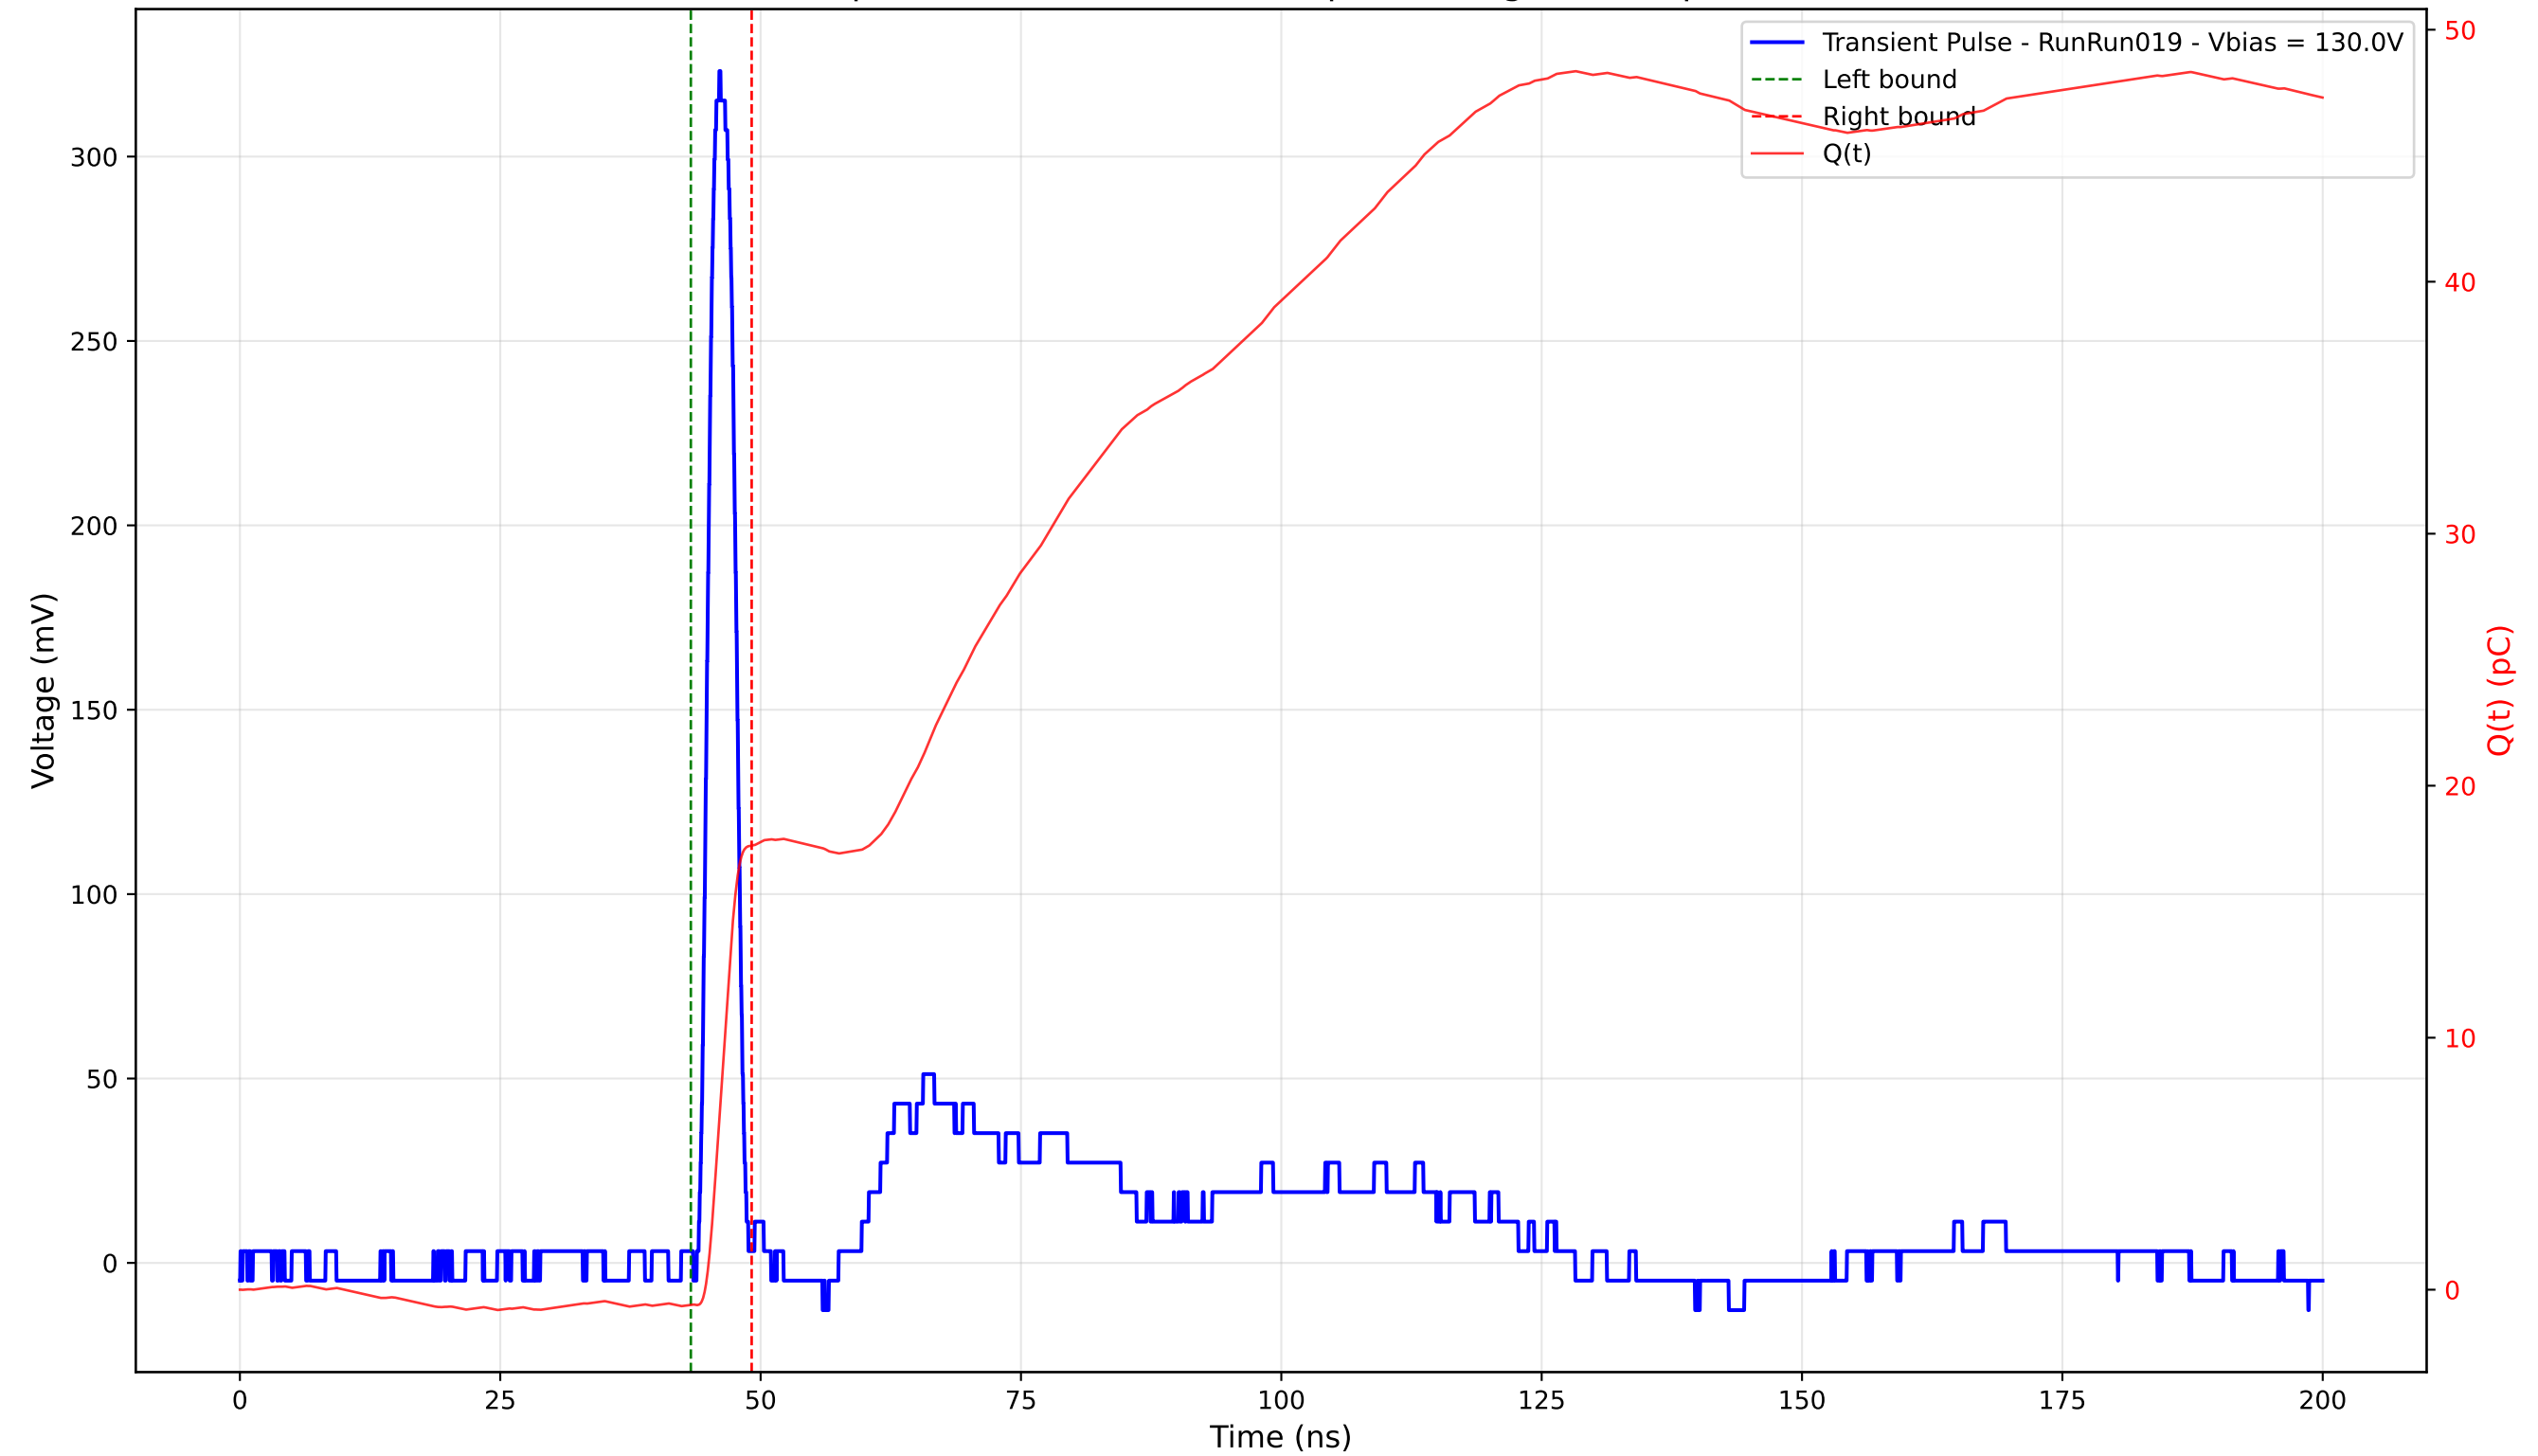


Transient Pulse - Sample: 4003 - Position: 235.0 μm - Charge: 18.22 pC - Rise Time: 1.23 ns

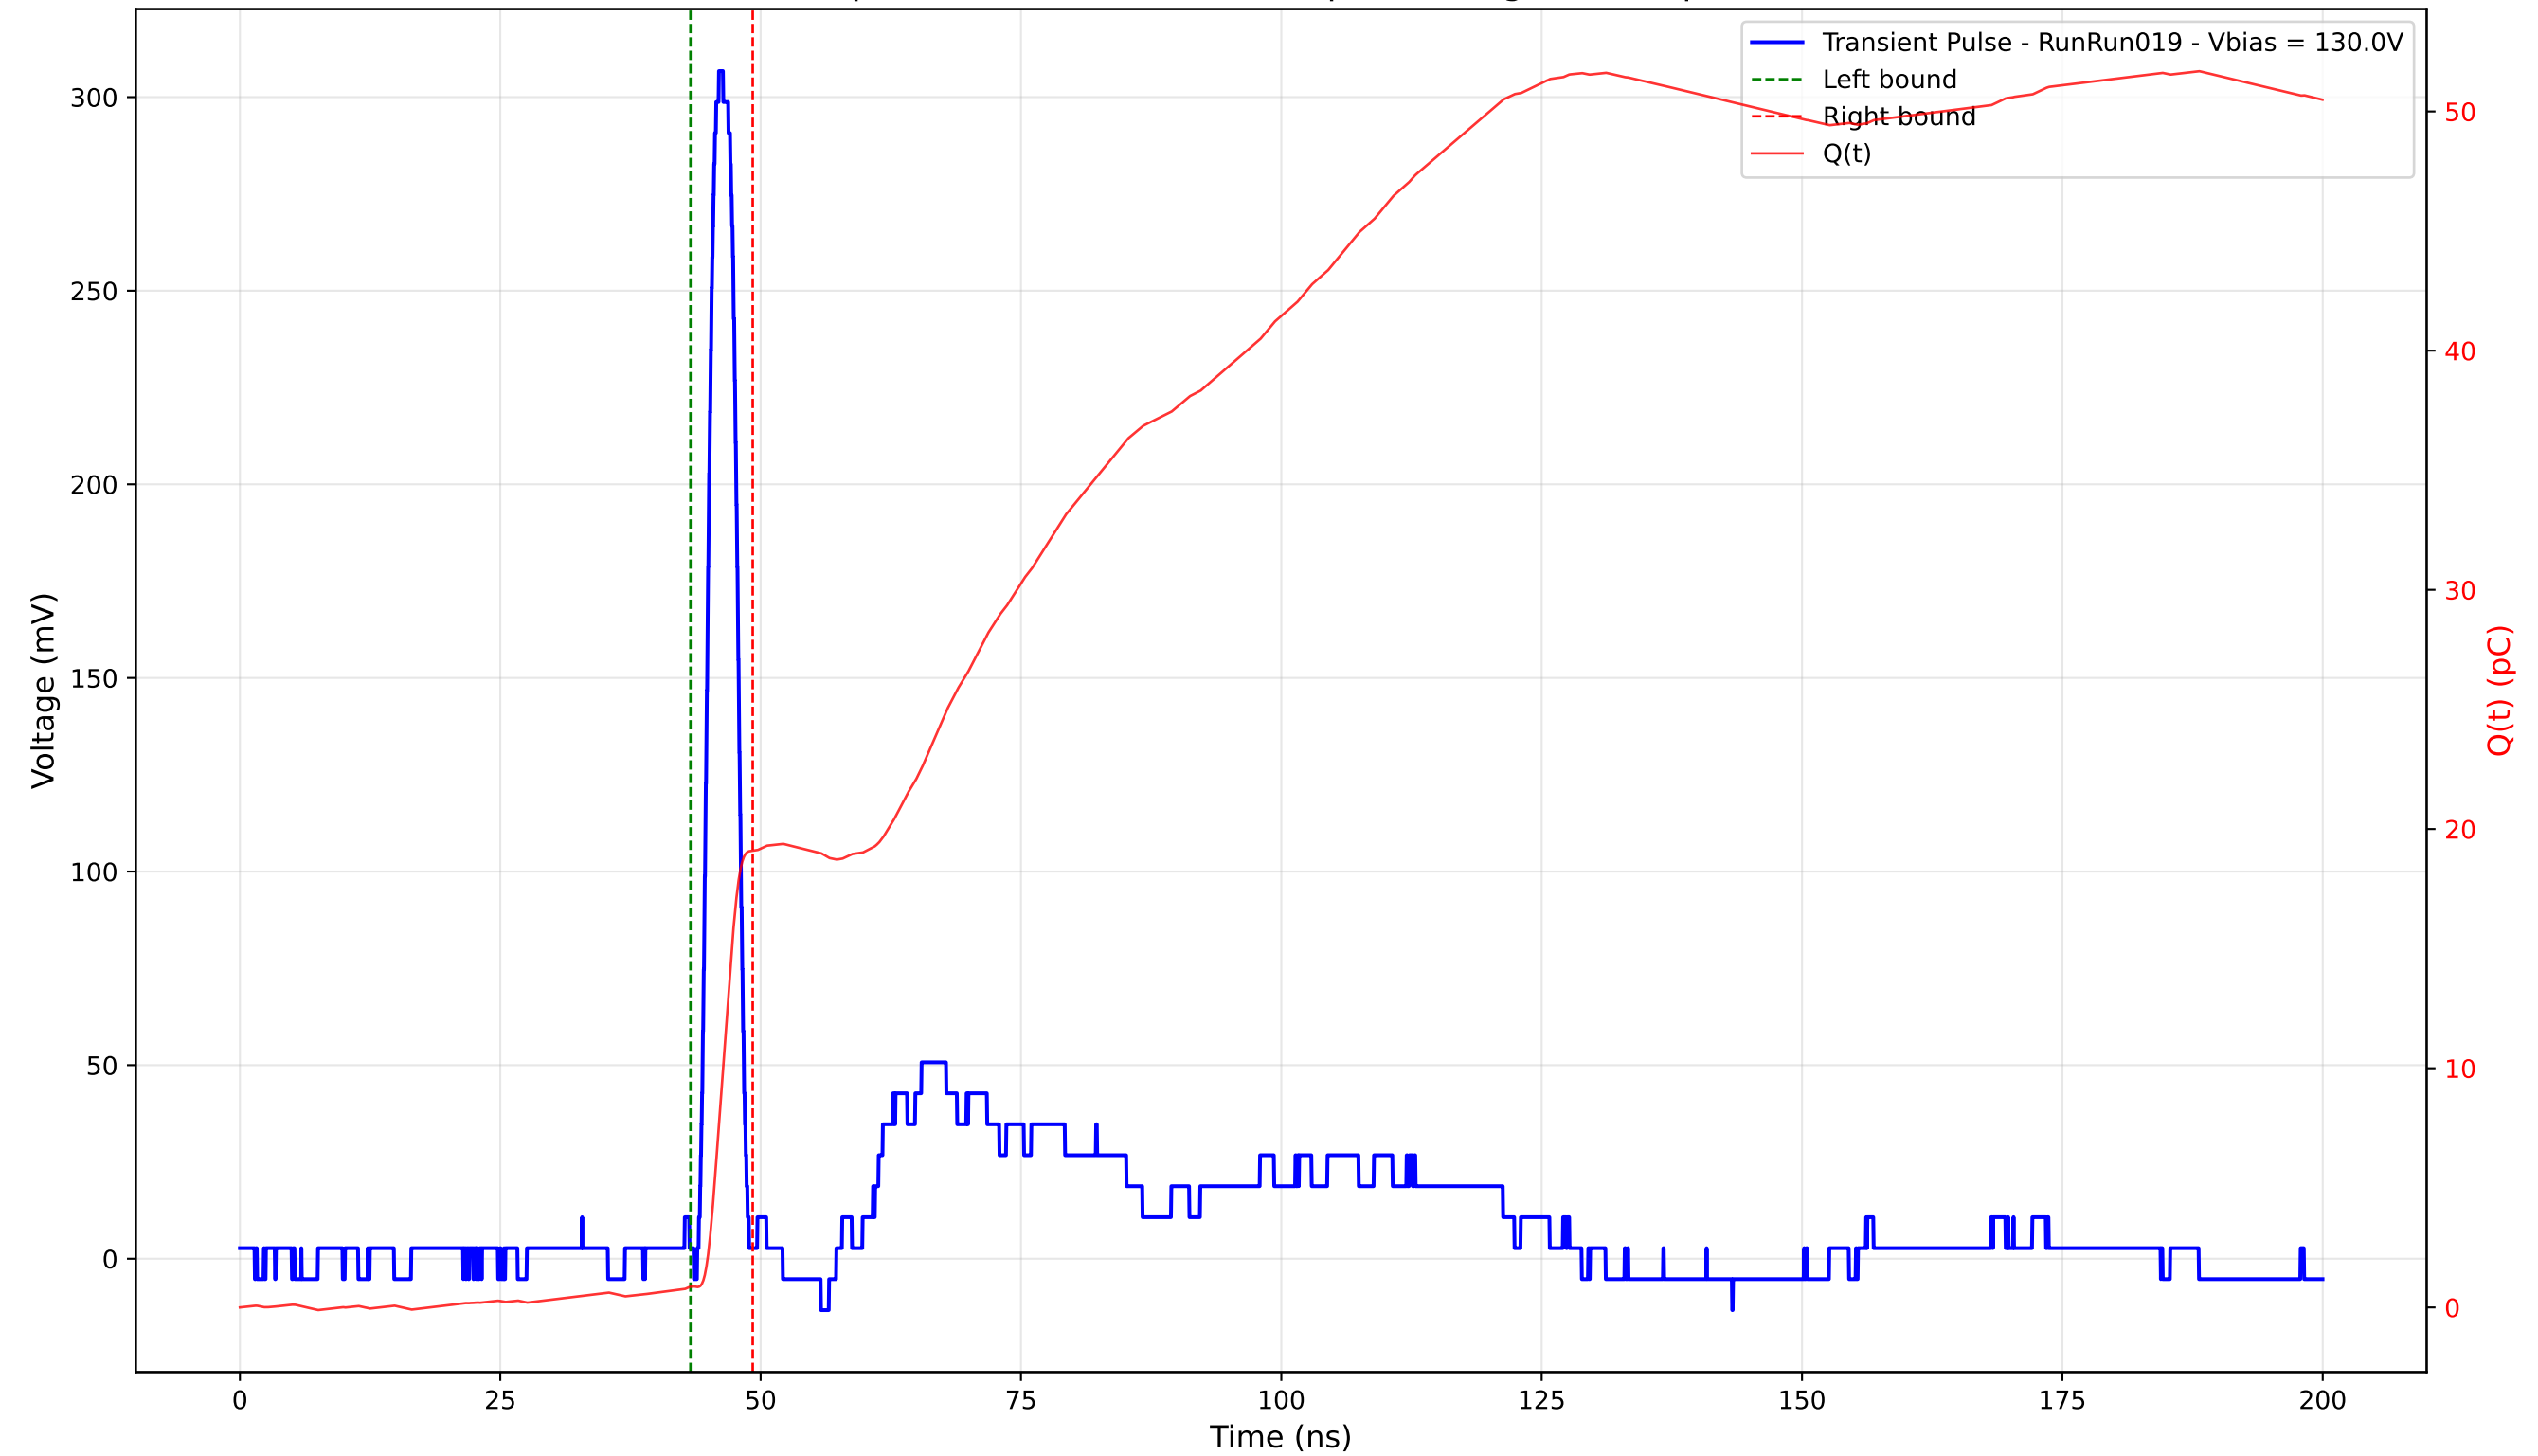


Transient Pulse - Sample: 4003 - Position: 240.0 μm - Charge: 17.96 pC - Rise Time: 1.18 ns

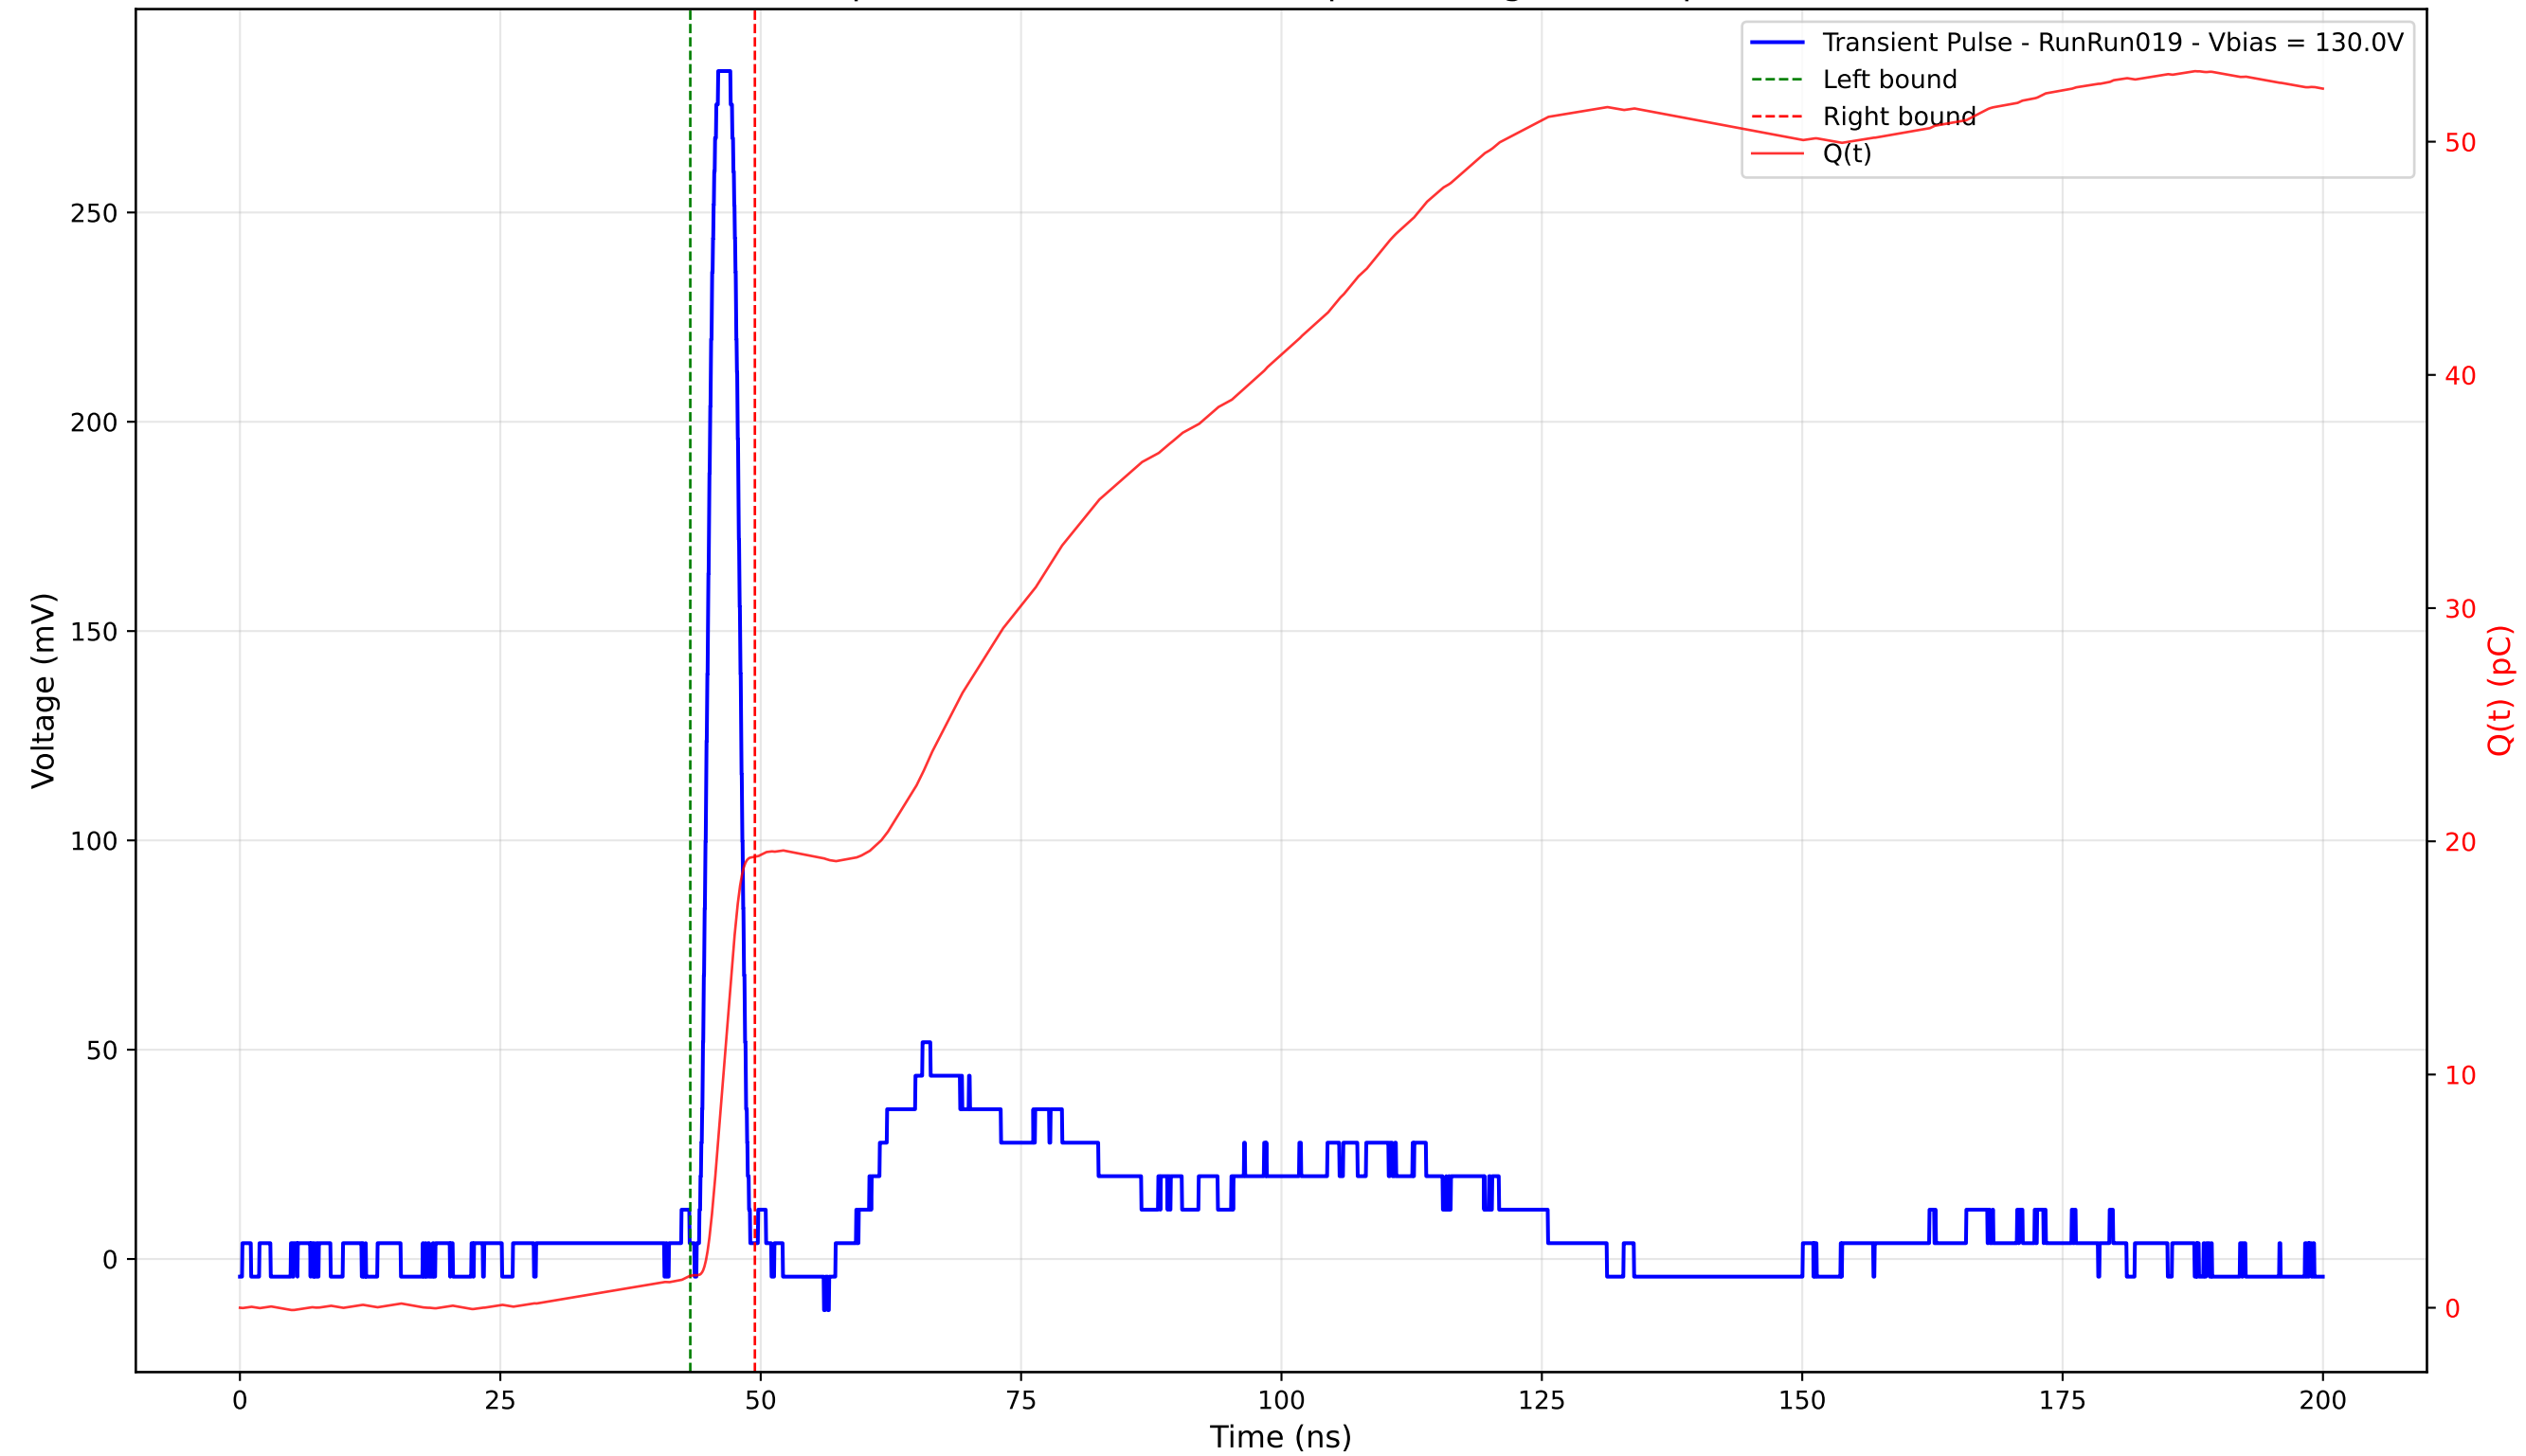


Transient Pulse - Sample: 4003 - Position: 245.0 μm - Charge: 17.71 pC - Rise Time: 1.28 ns

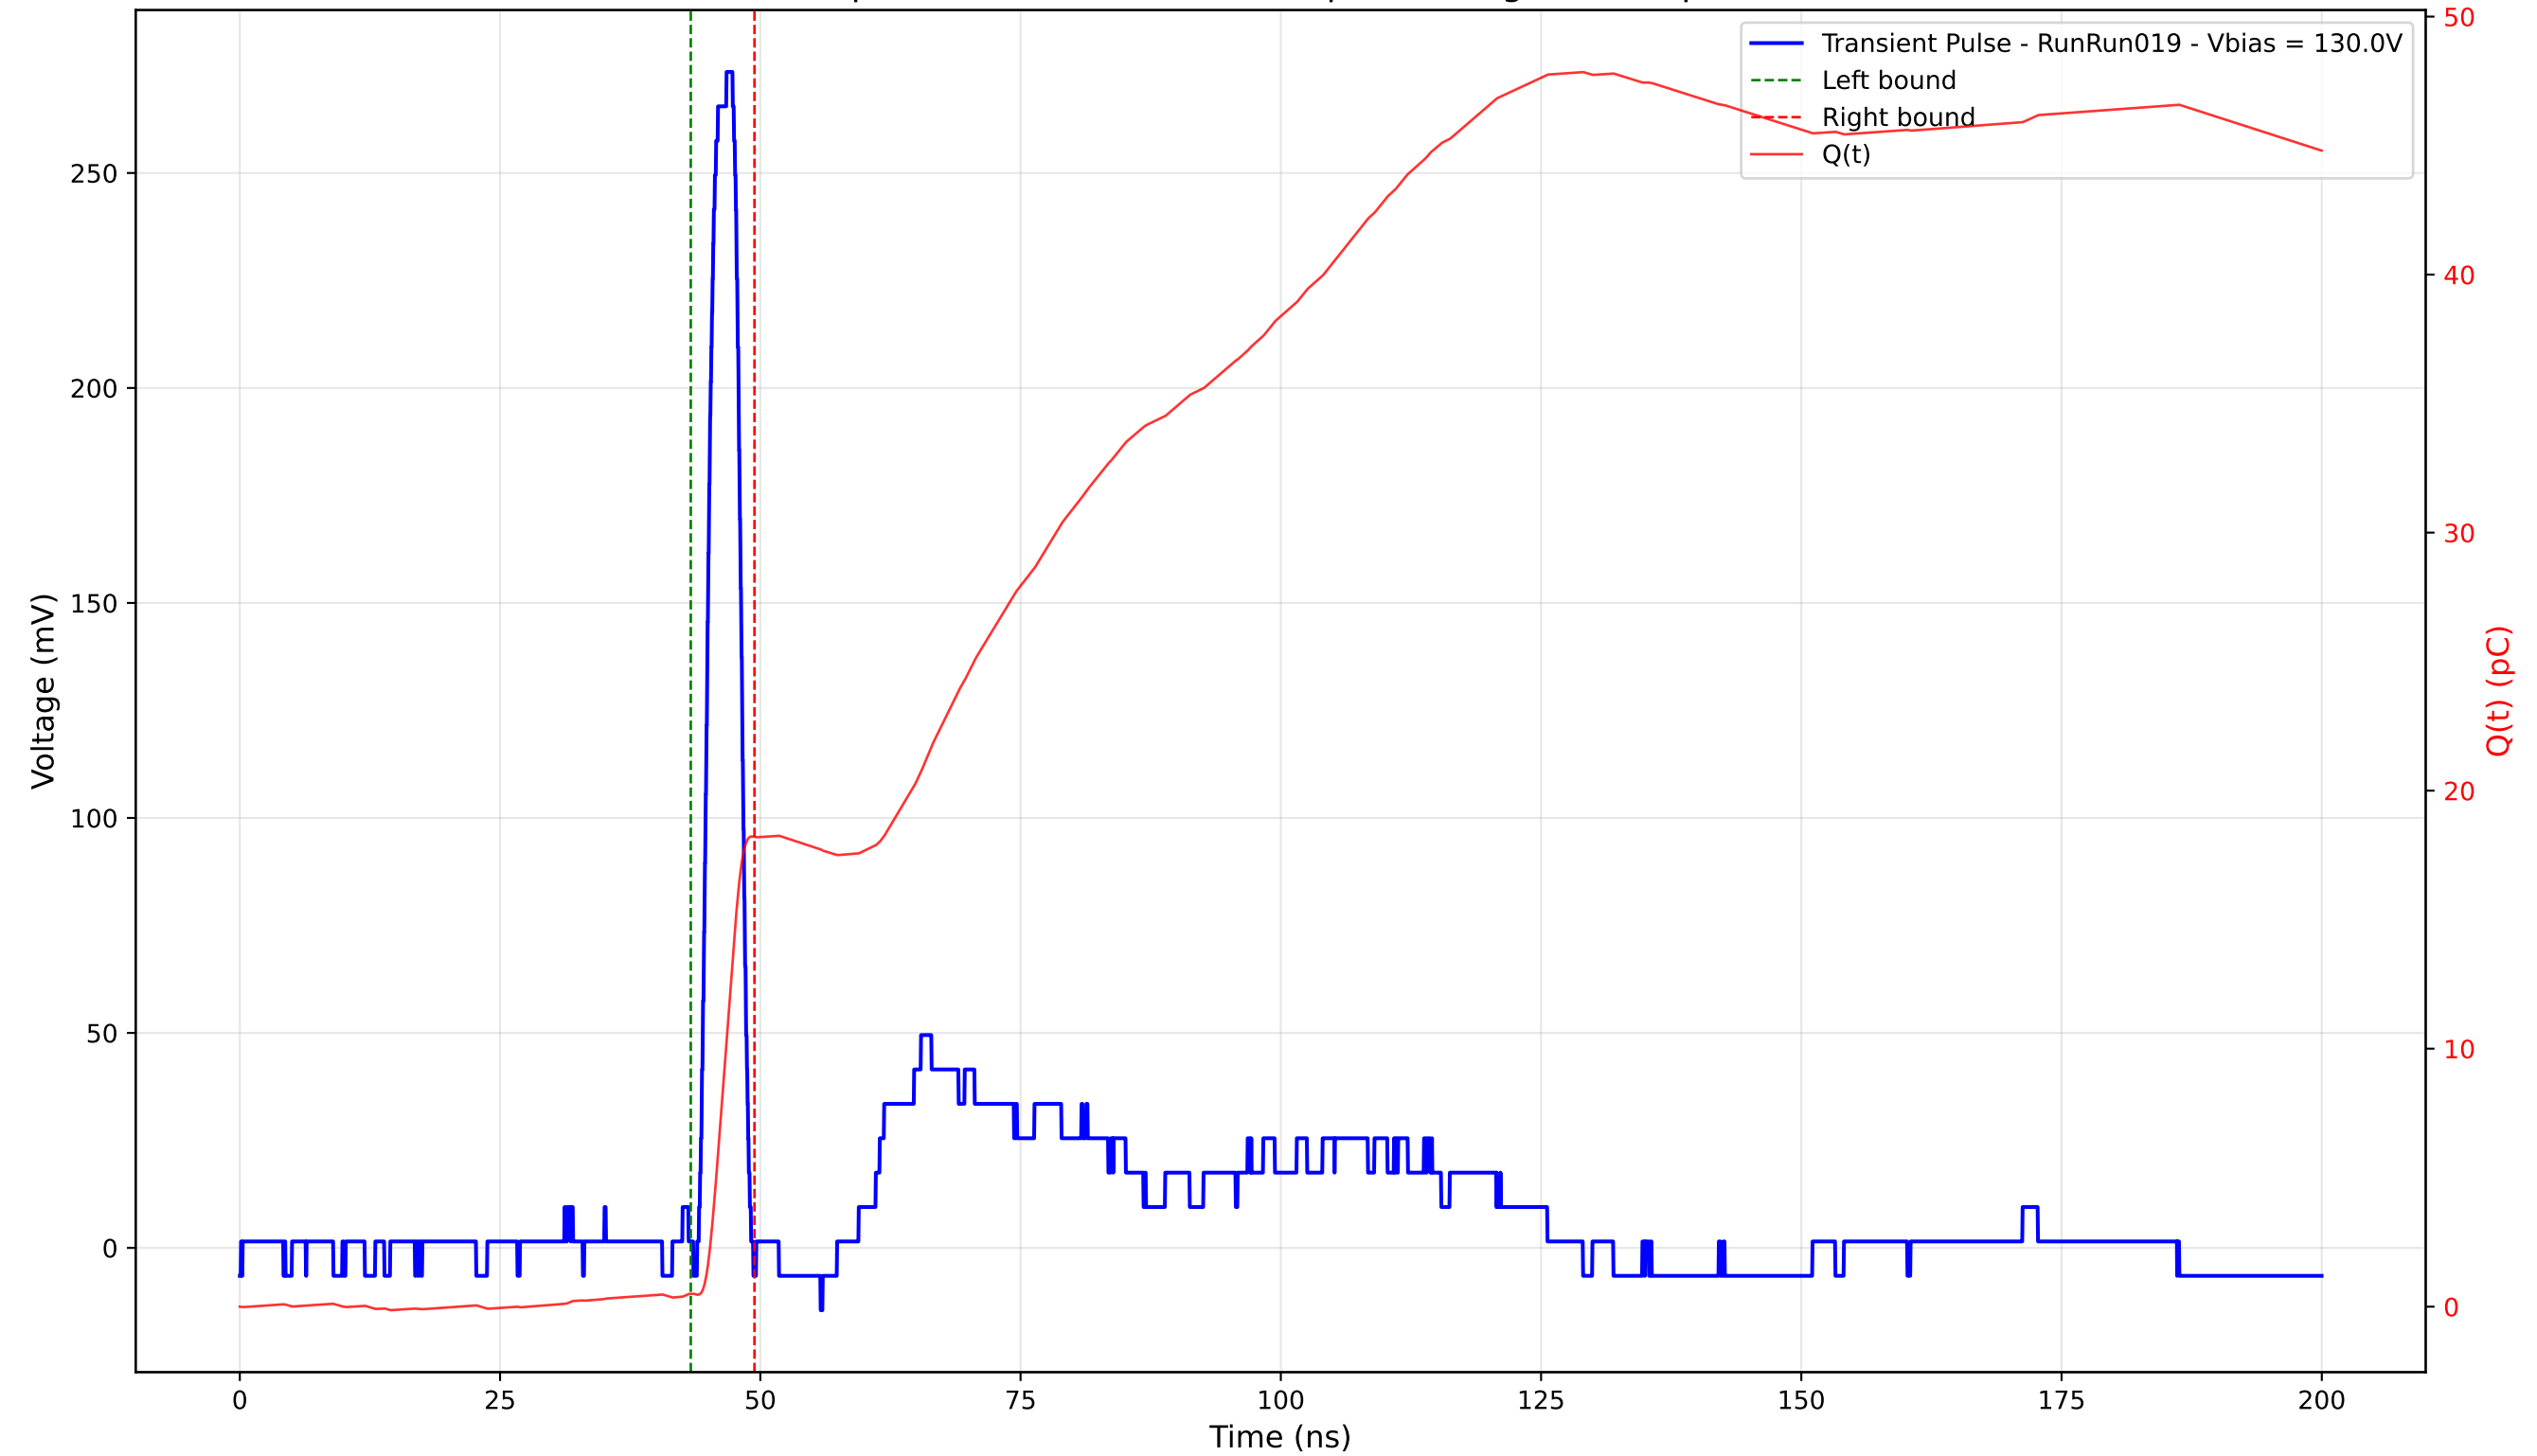


Transient Pulse - Sample: 4003 - Position: 250.0 μm - Charge: 17.51 pC - Rise Time: 1.37 ns

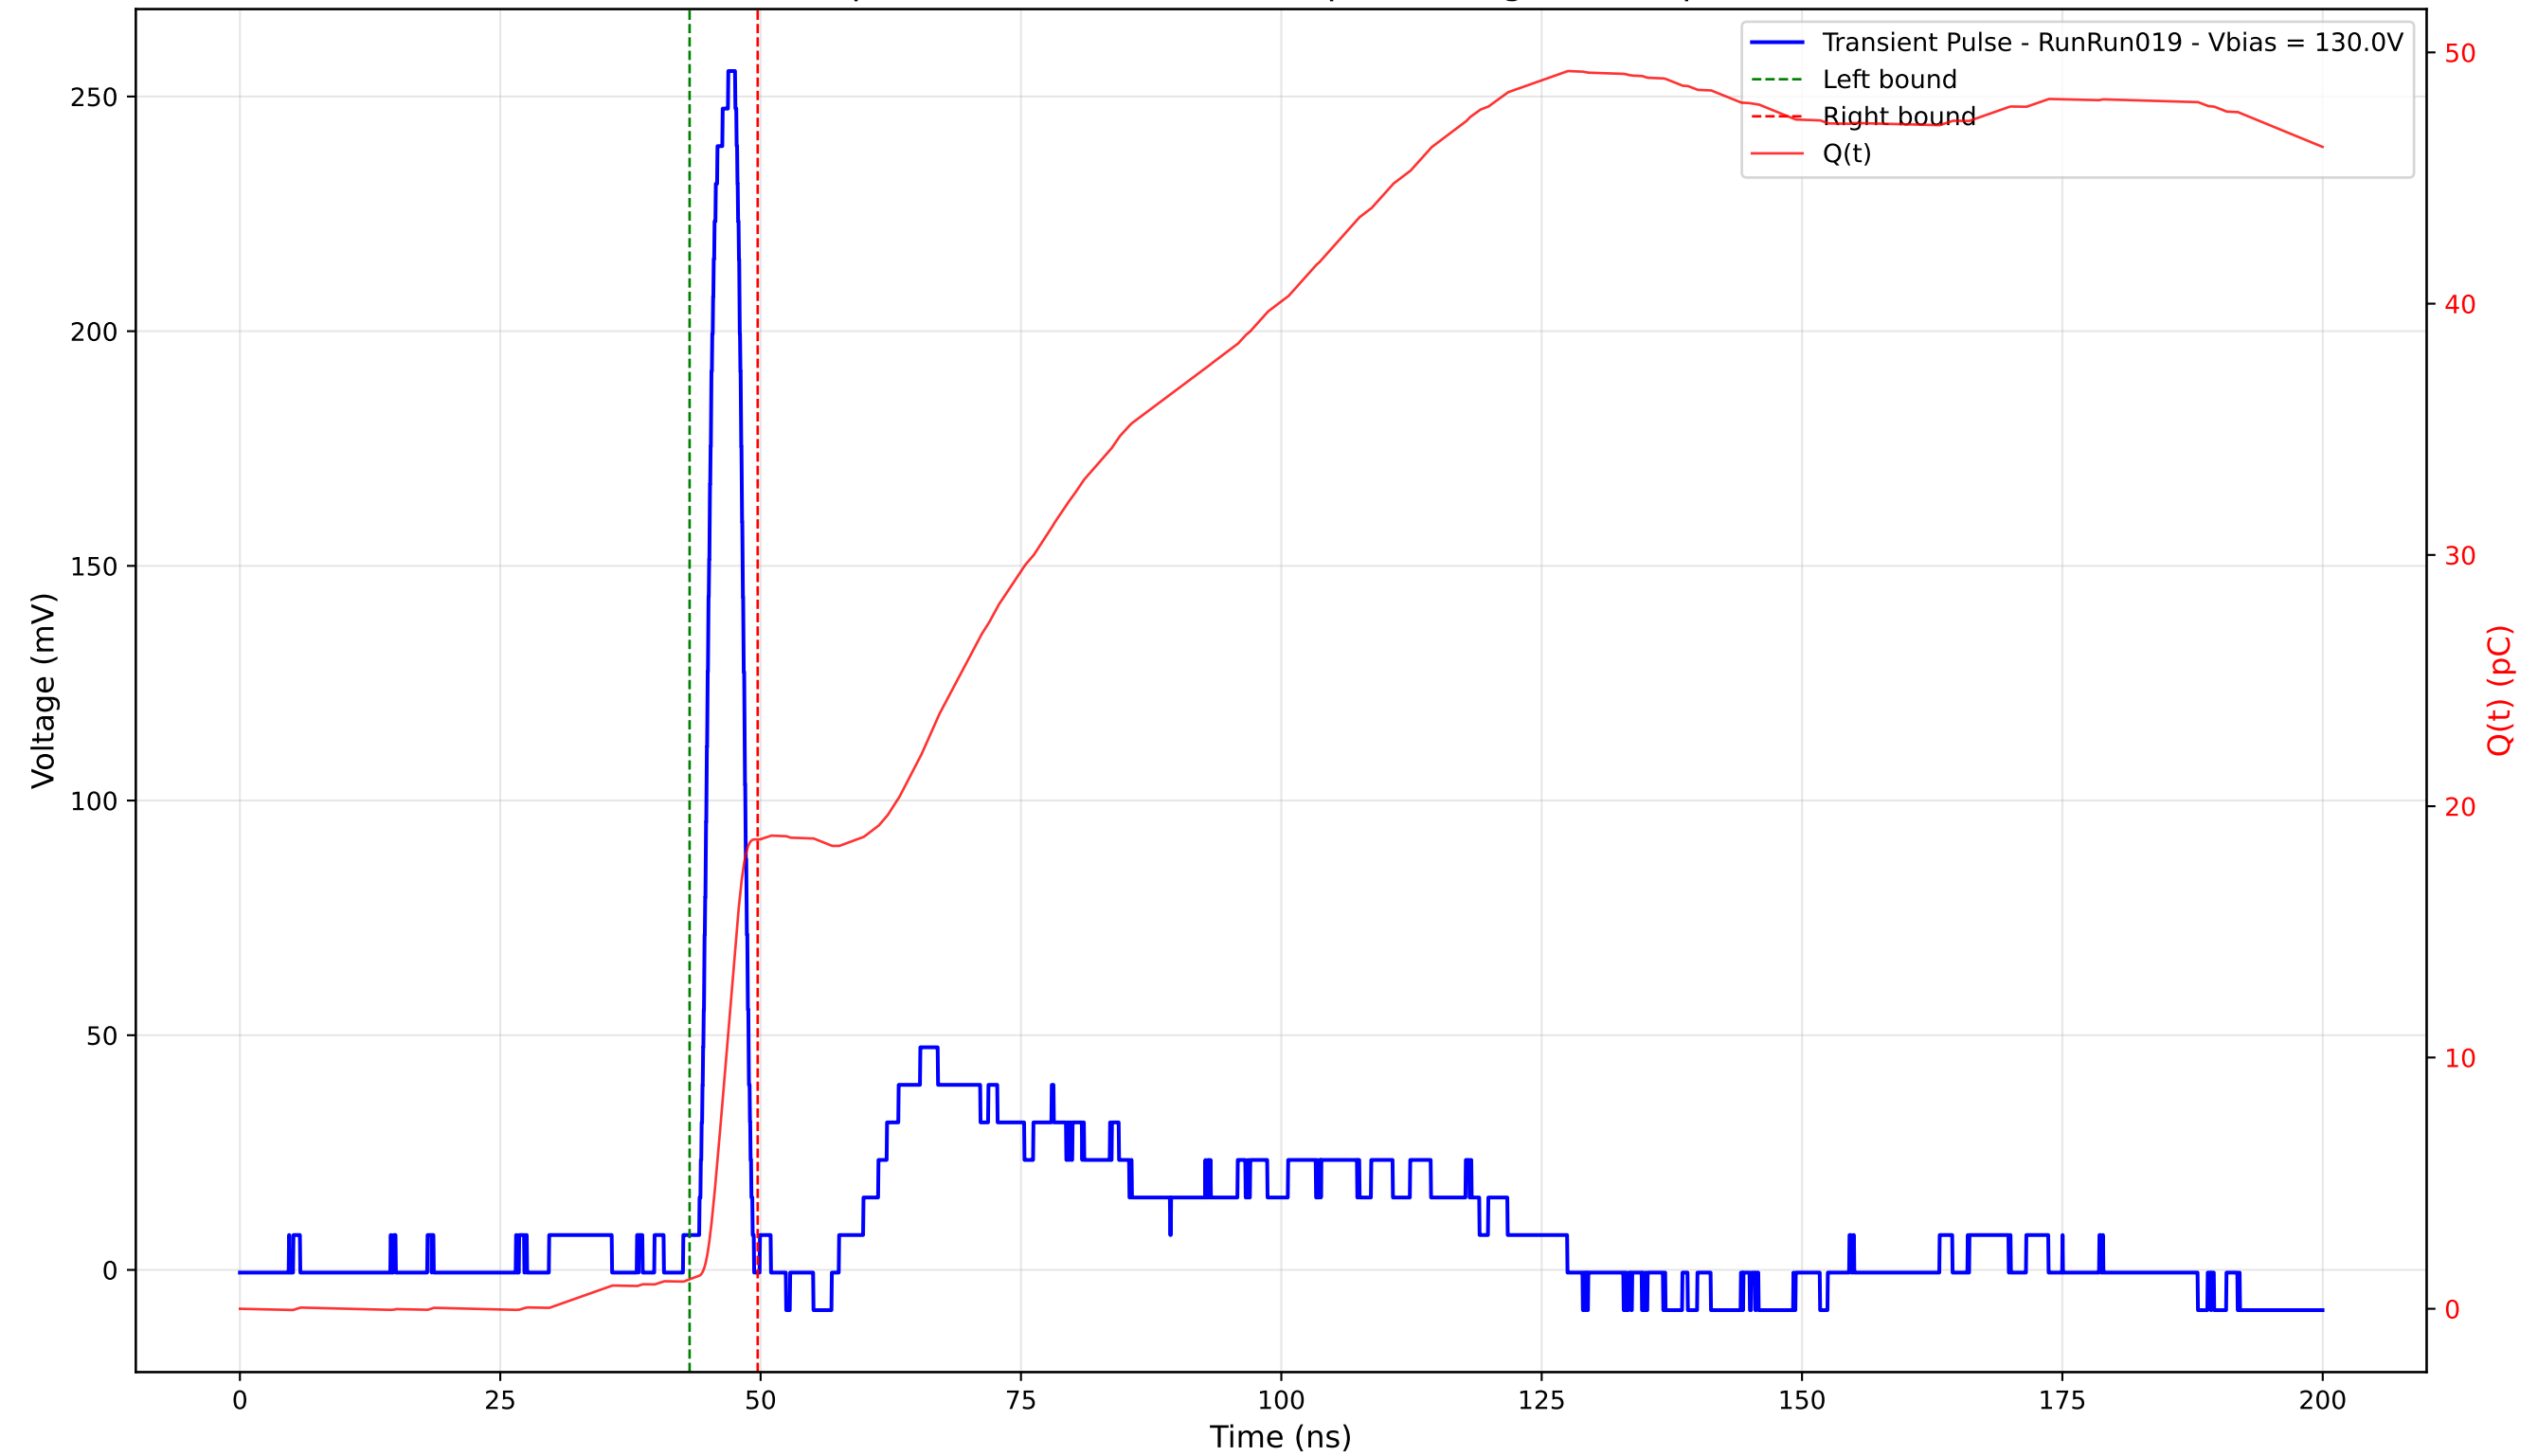


Transient Pulse - Sample: 4003 - Position: 255.0 μm - Charge: 16.90 pC - Rise Time: 1.45 ns

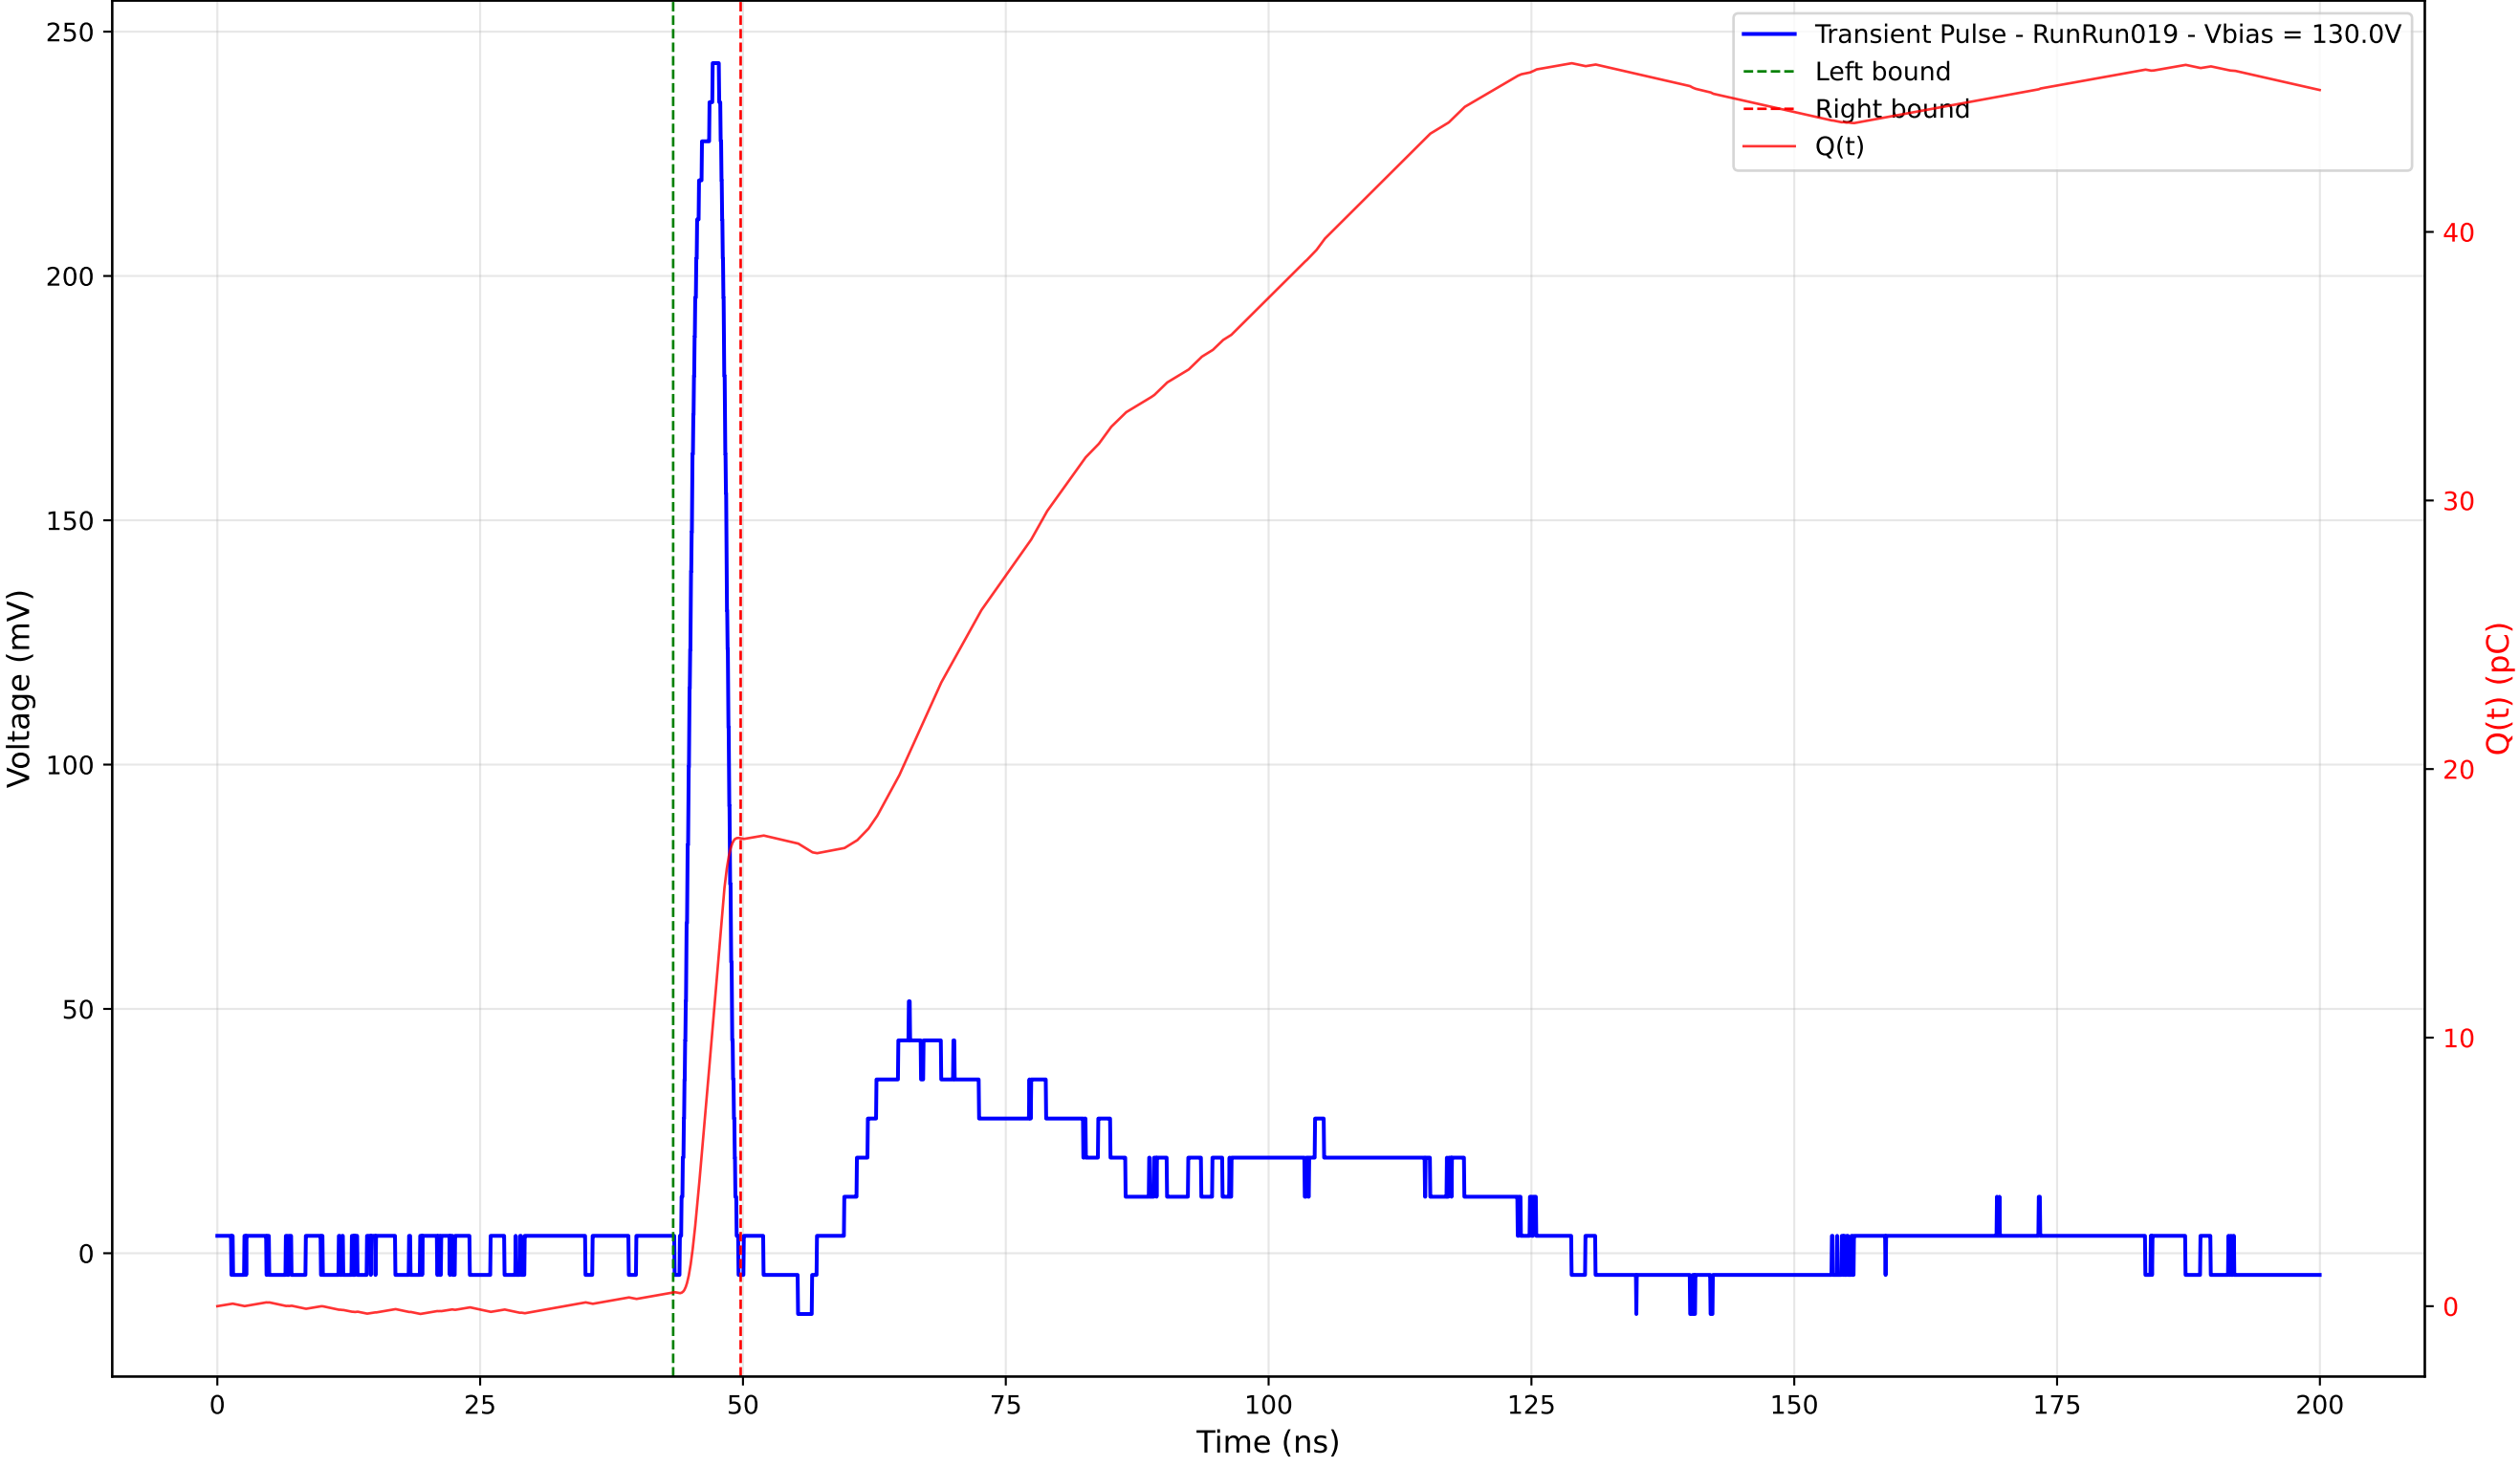


Transient Pulse - Sample: 4003 - Position: 260.0 μm - Charge: 16.14 pC - Rise Time: 2.80 ns

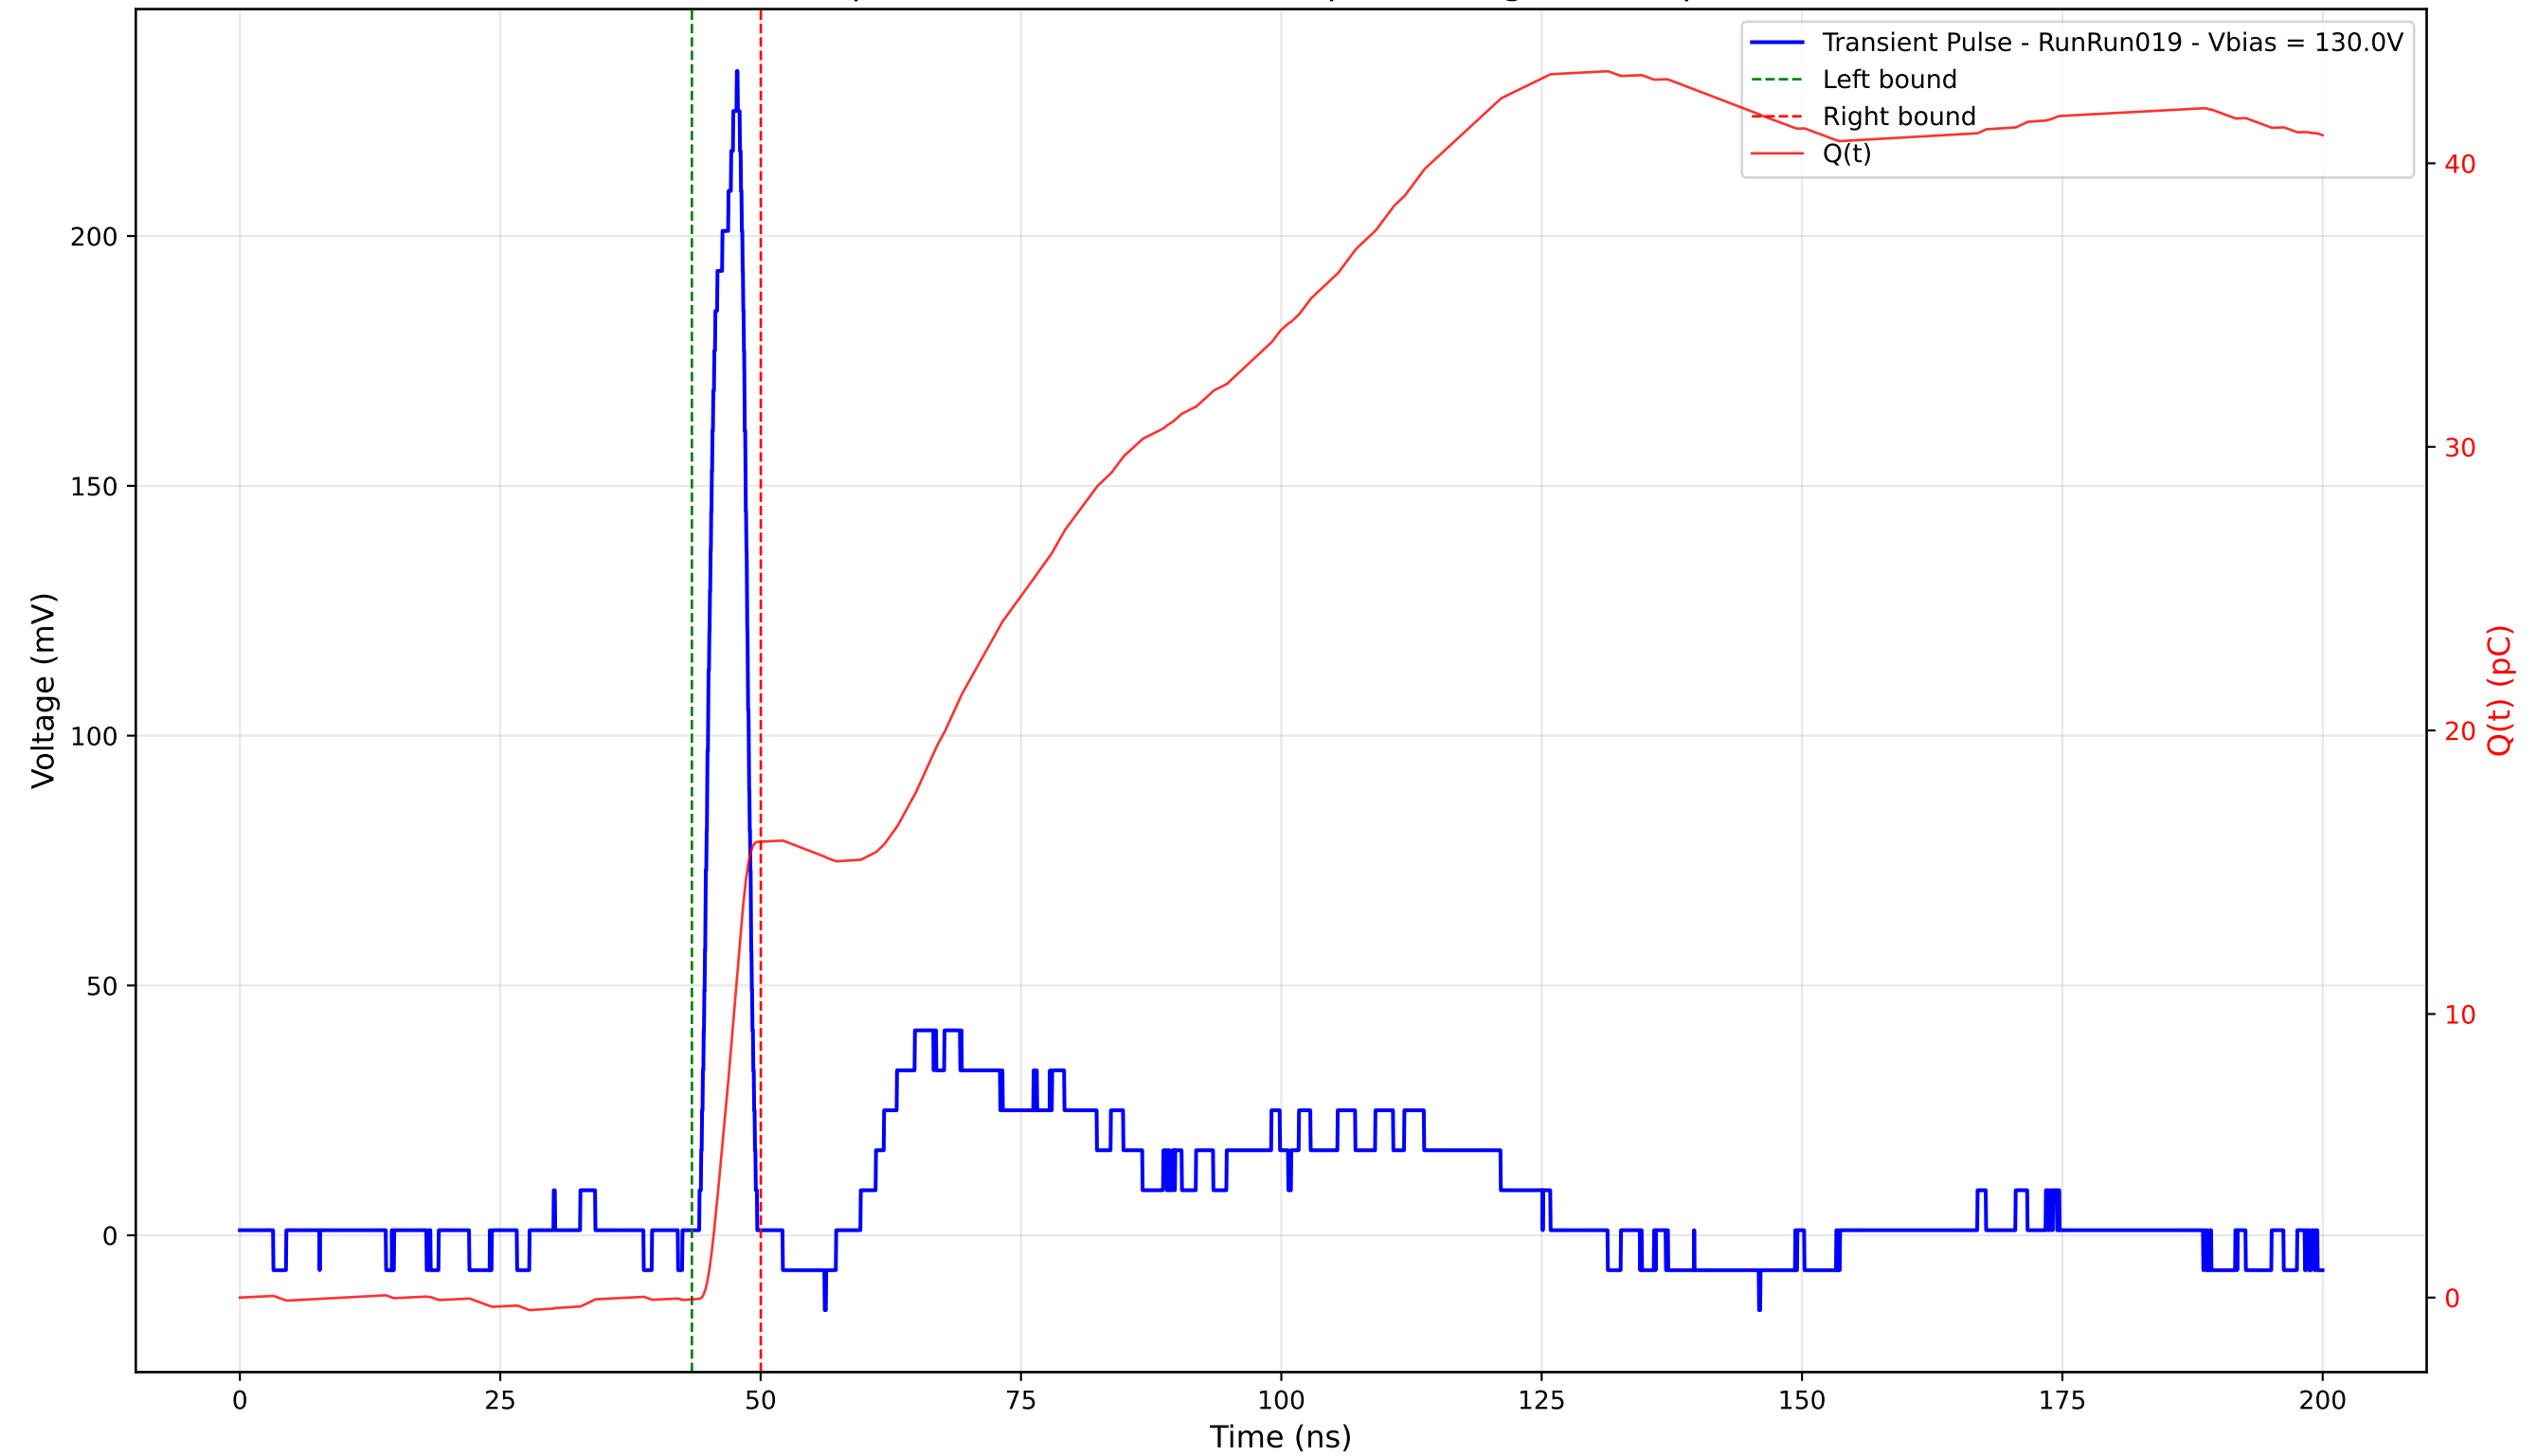


Transient Pulse - Sample: 4003 - Position: 265.0 μm - Charge: 15.68 pC - Rise Time: 2.85 ns

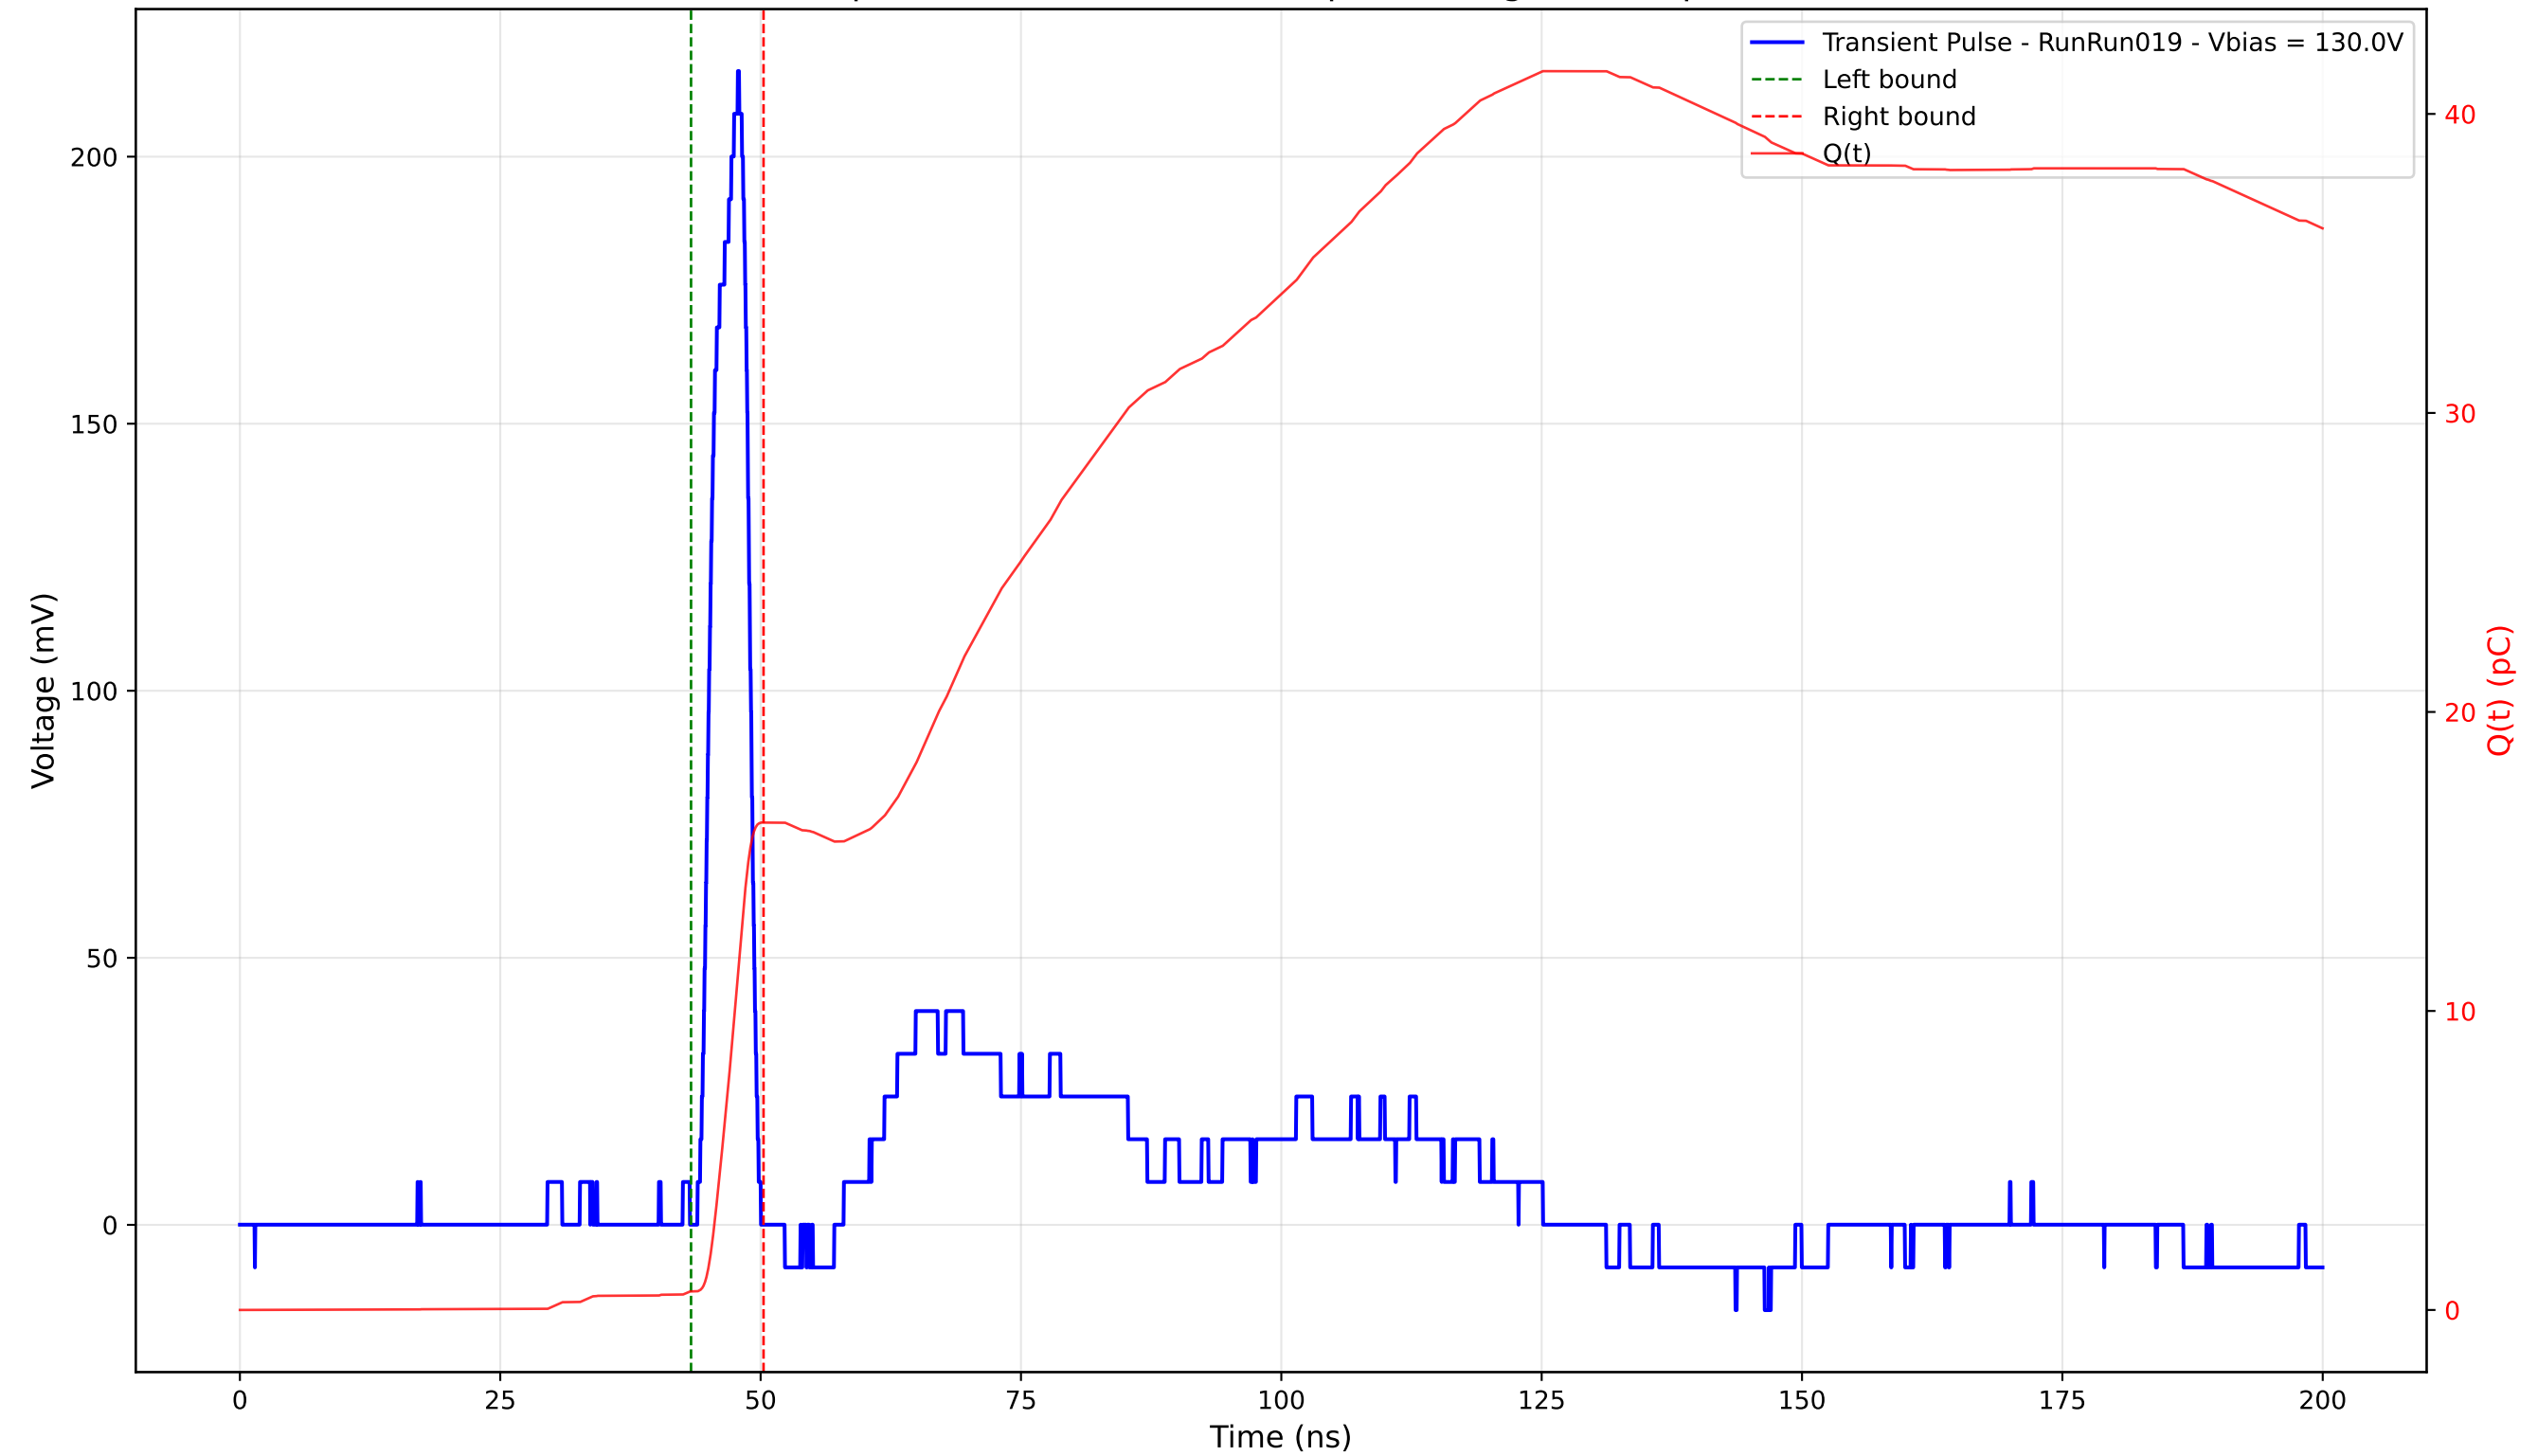


Transient Pulse - Sample: 4003 - Position: 270.0 μm - Charge: 14.49 pC - Rise Time: 2.74 ns

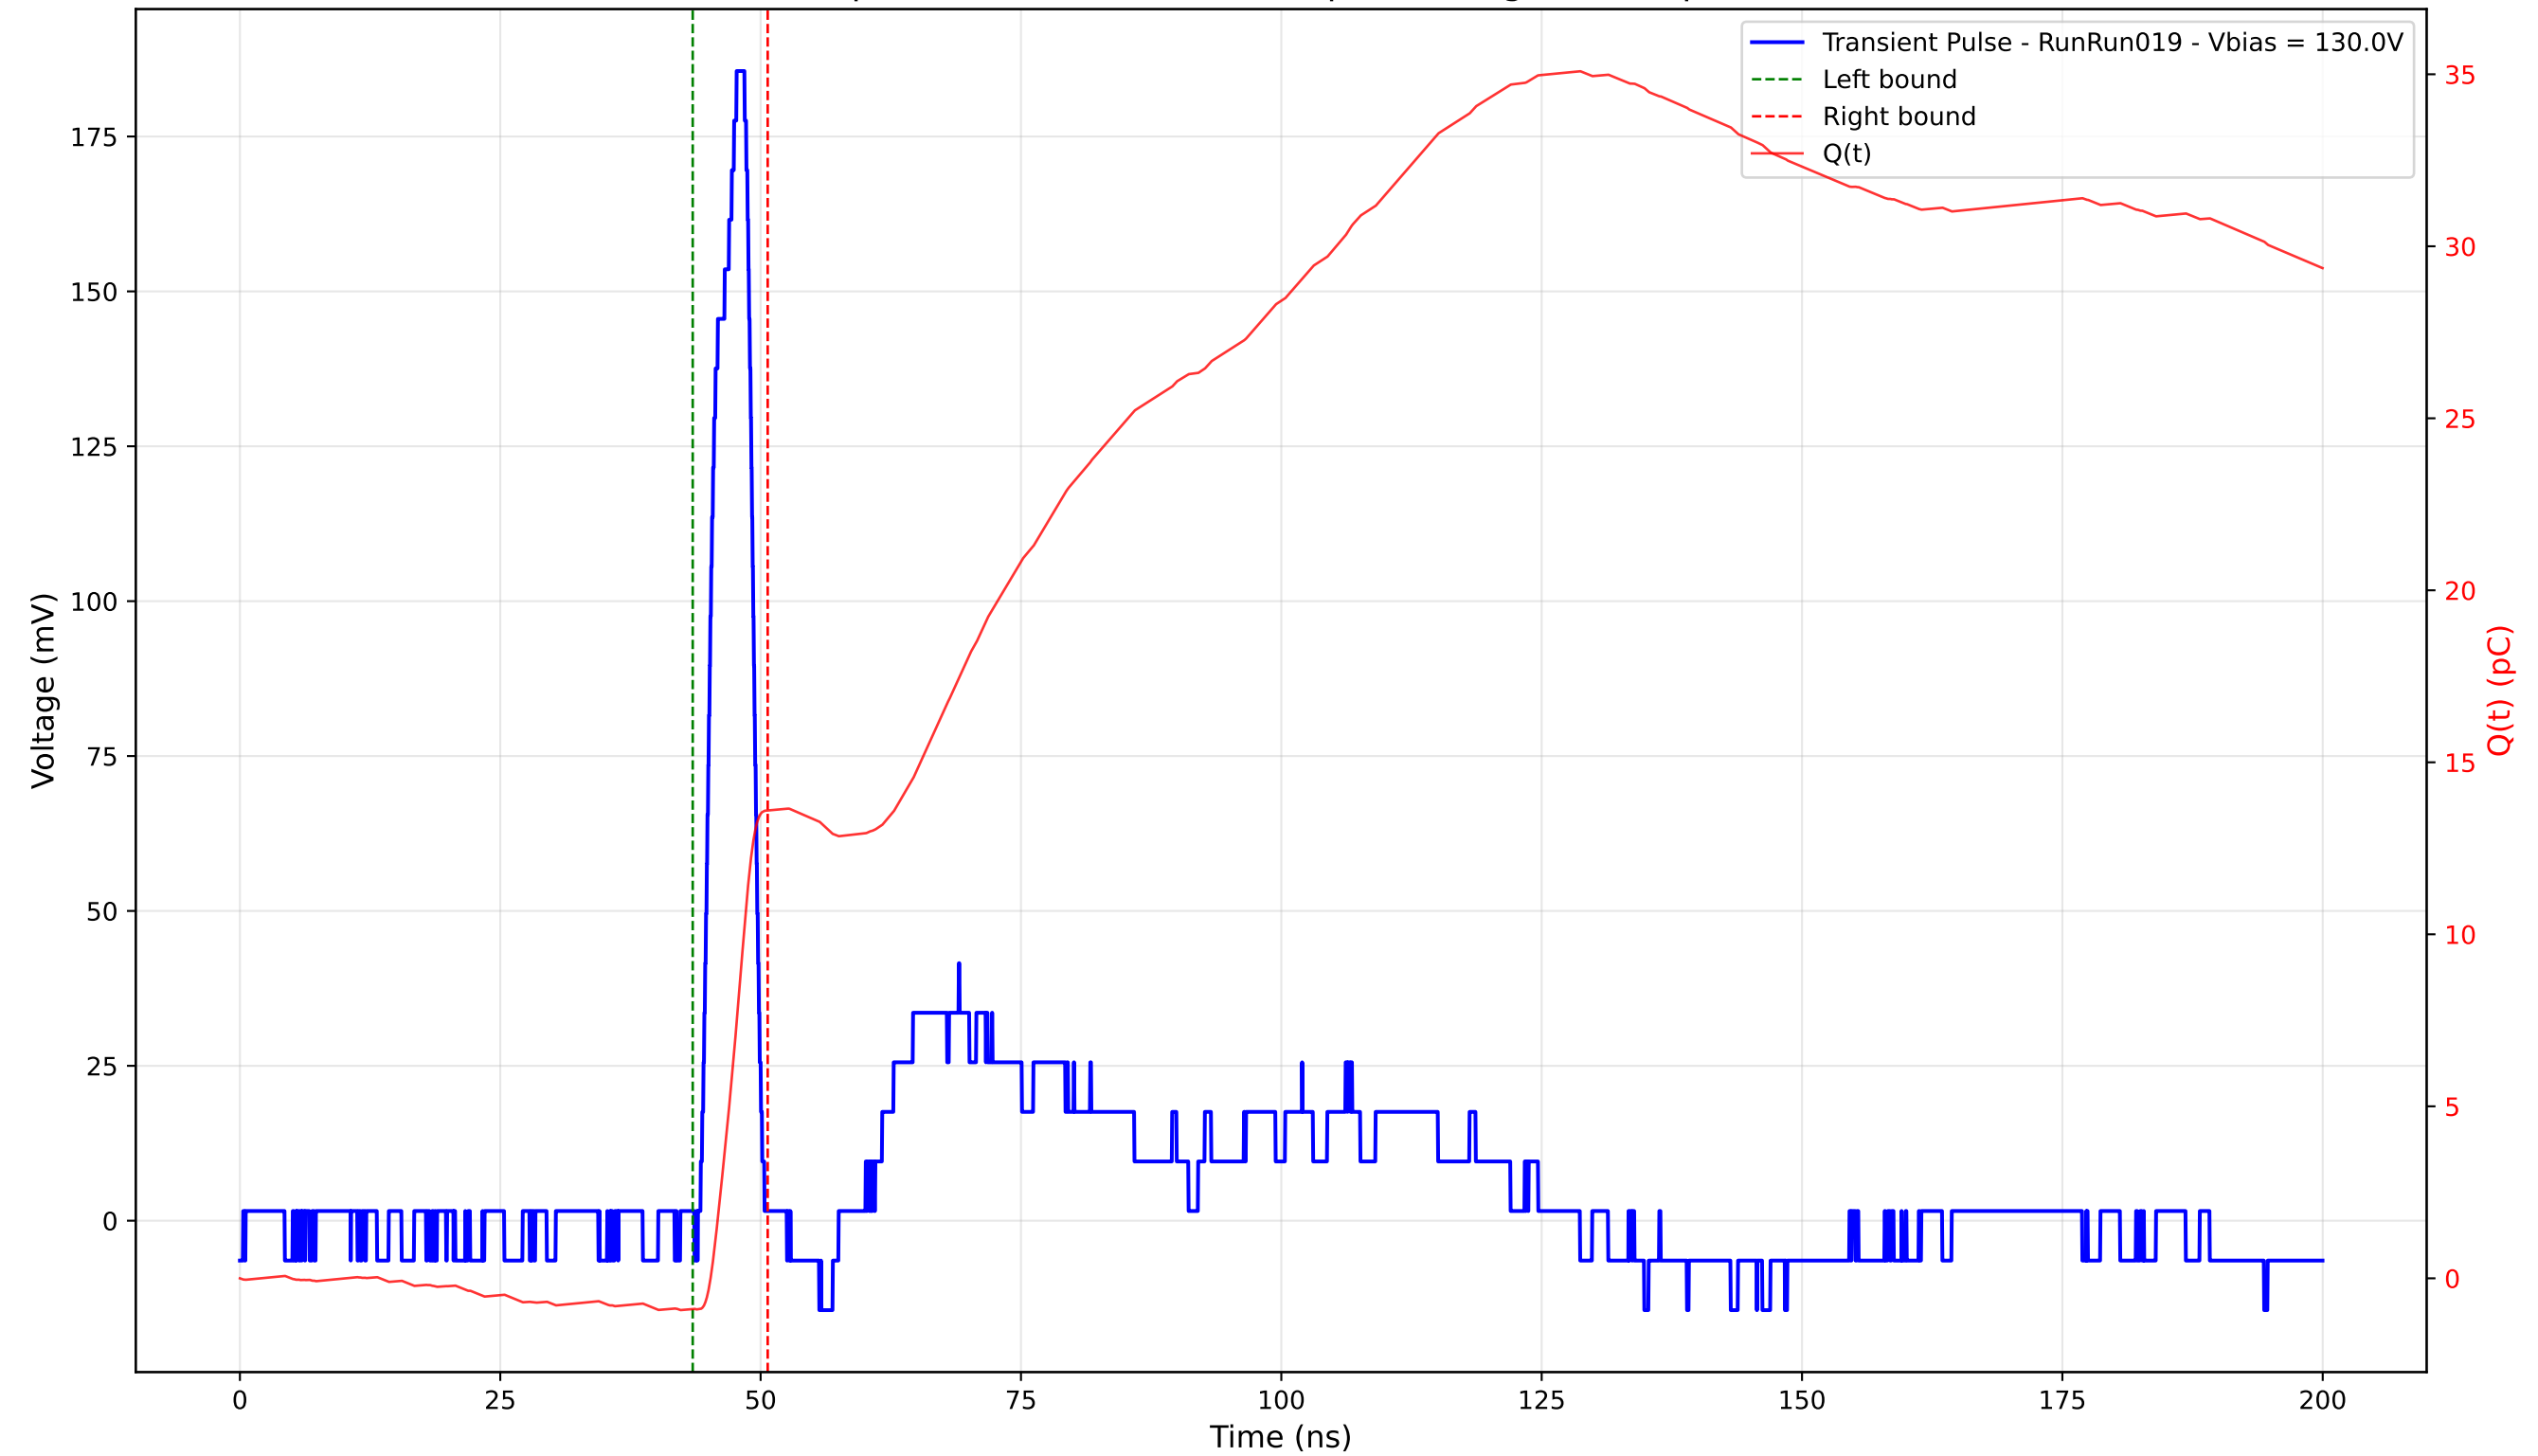


Transient Pulse - Sample: 4003 - Position: 275.0 μm - Charge: 13.98 pC - Rise Time: 3.18 ns

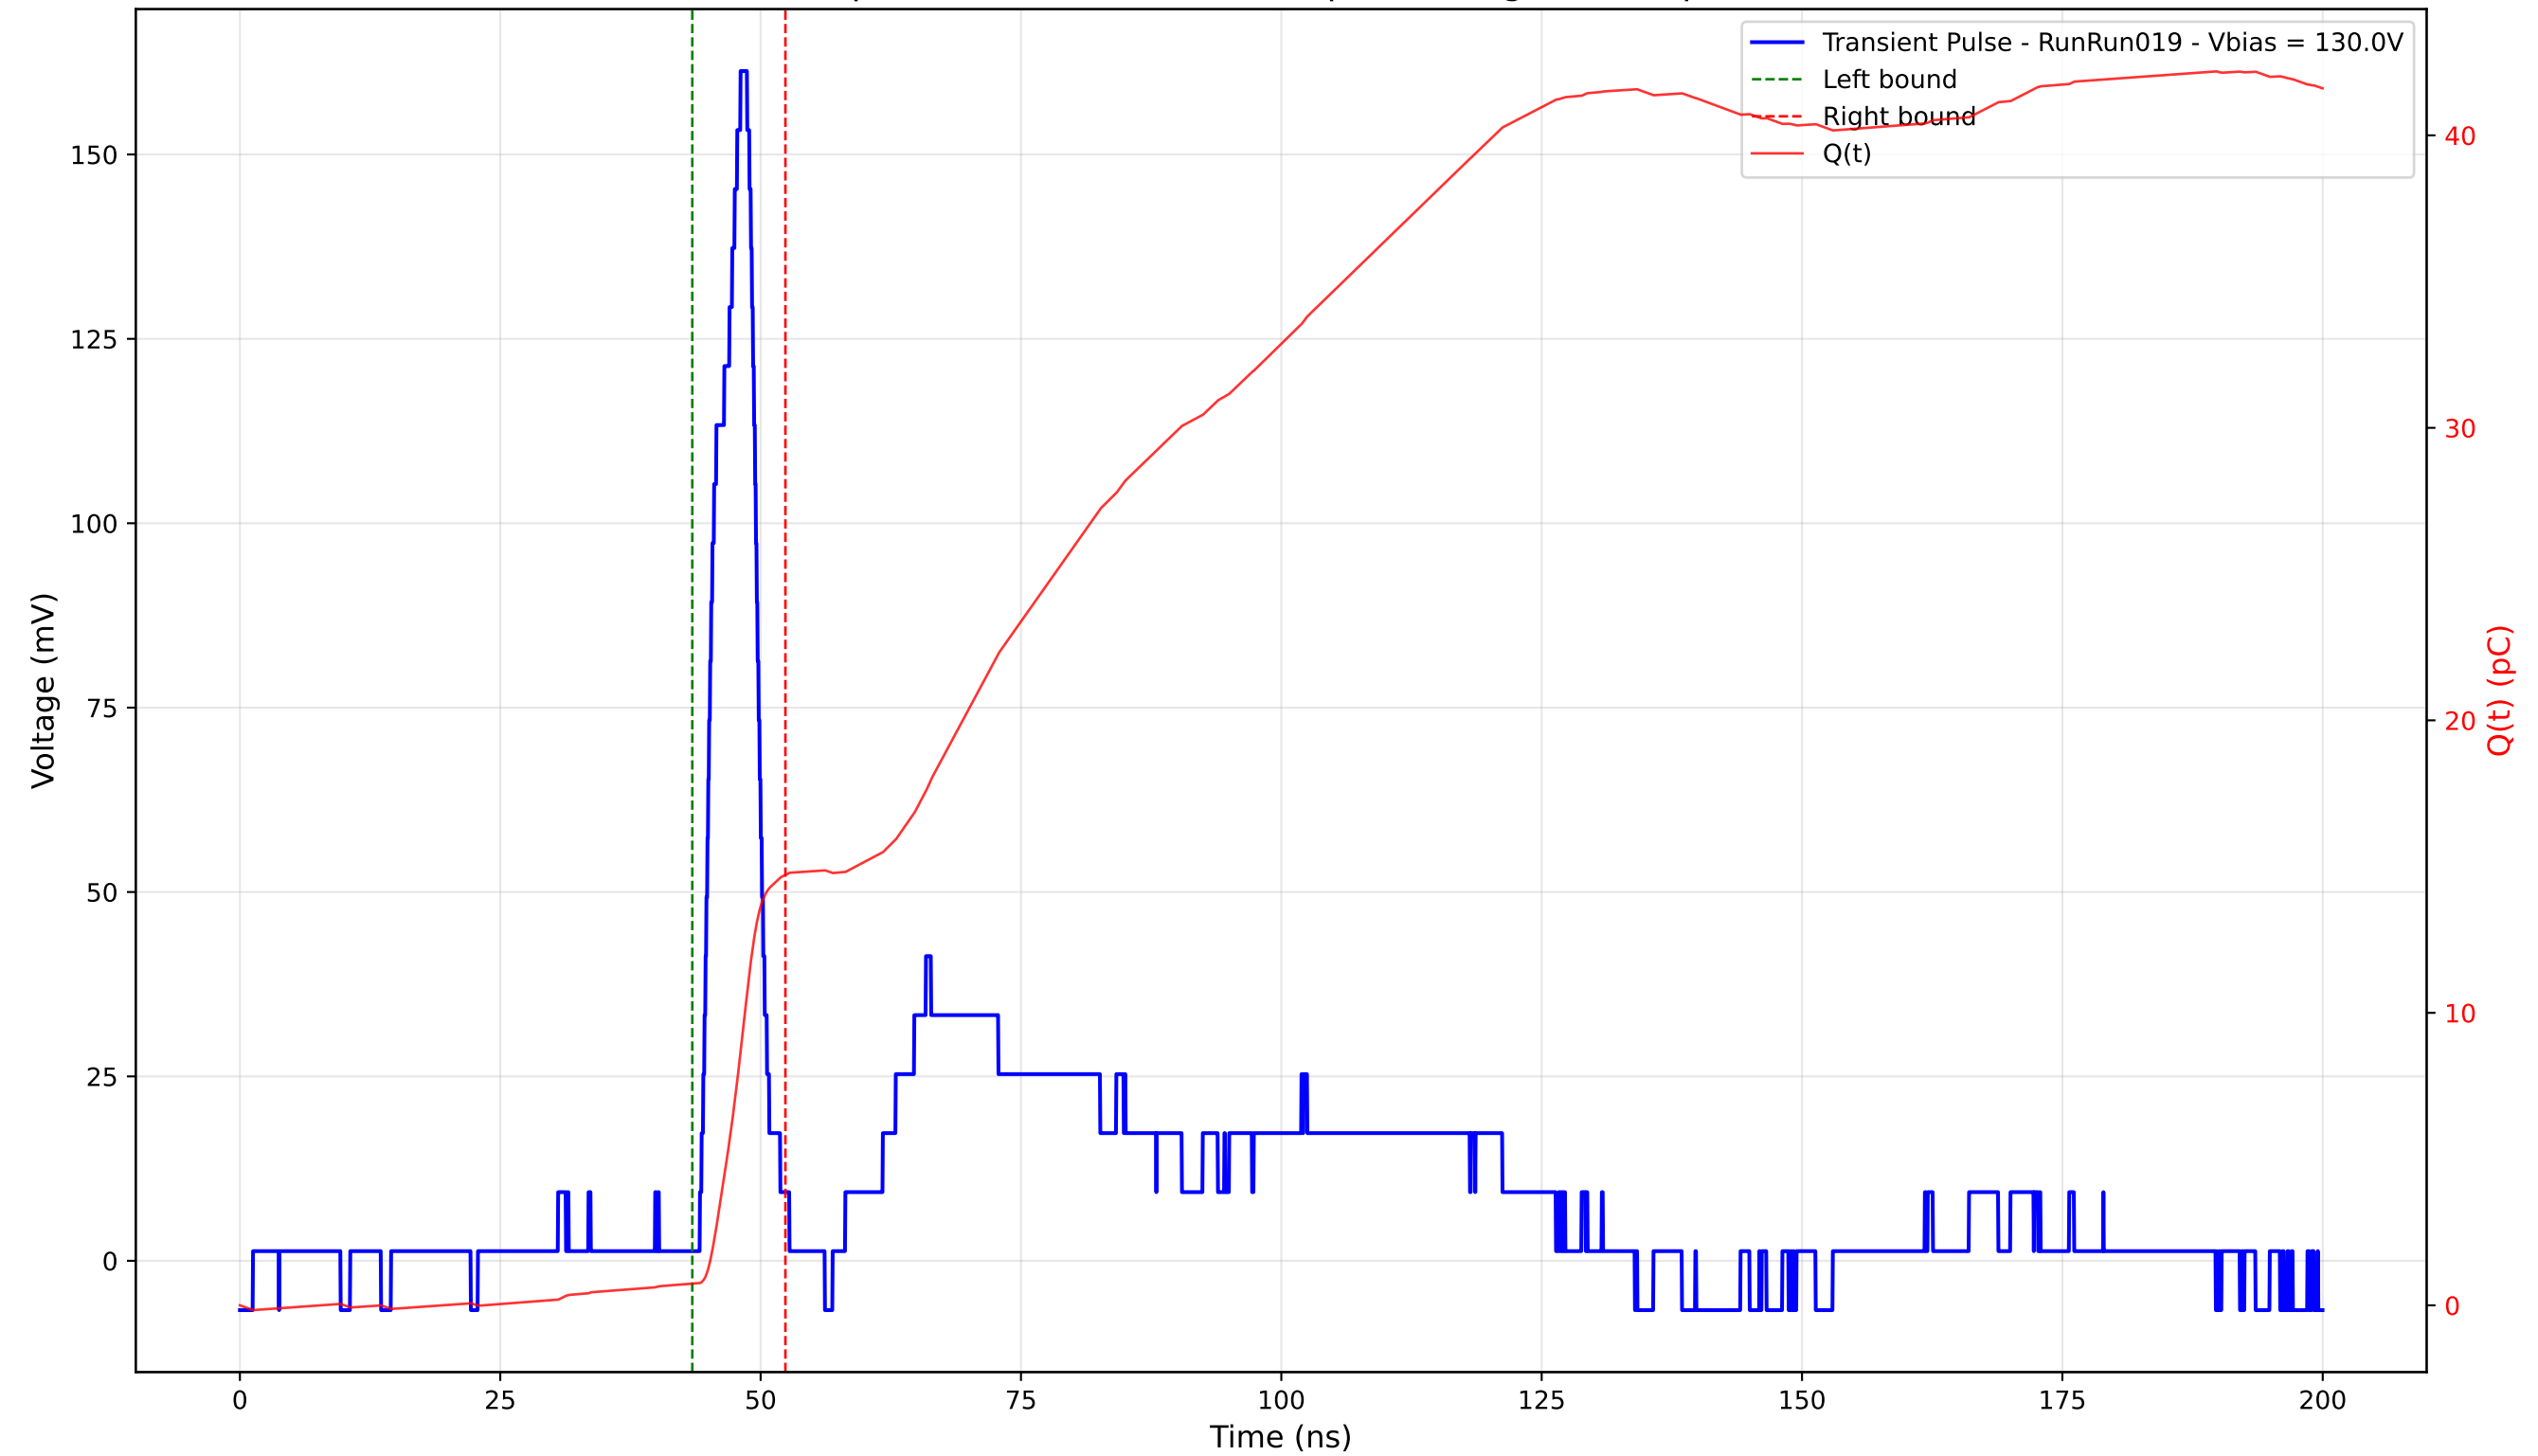


Transient Pulse - Sample: 4003 - Position: 280.0 μm - Charge: 12.78 pC - Rise Time: 3.52 ns

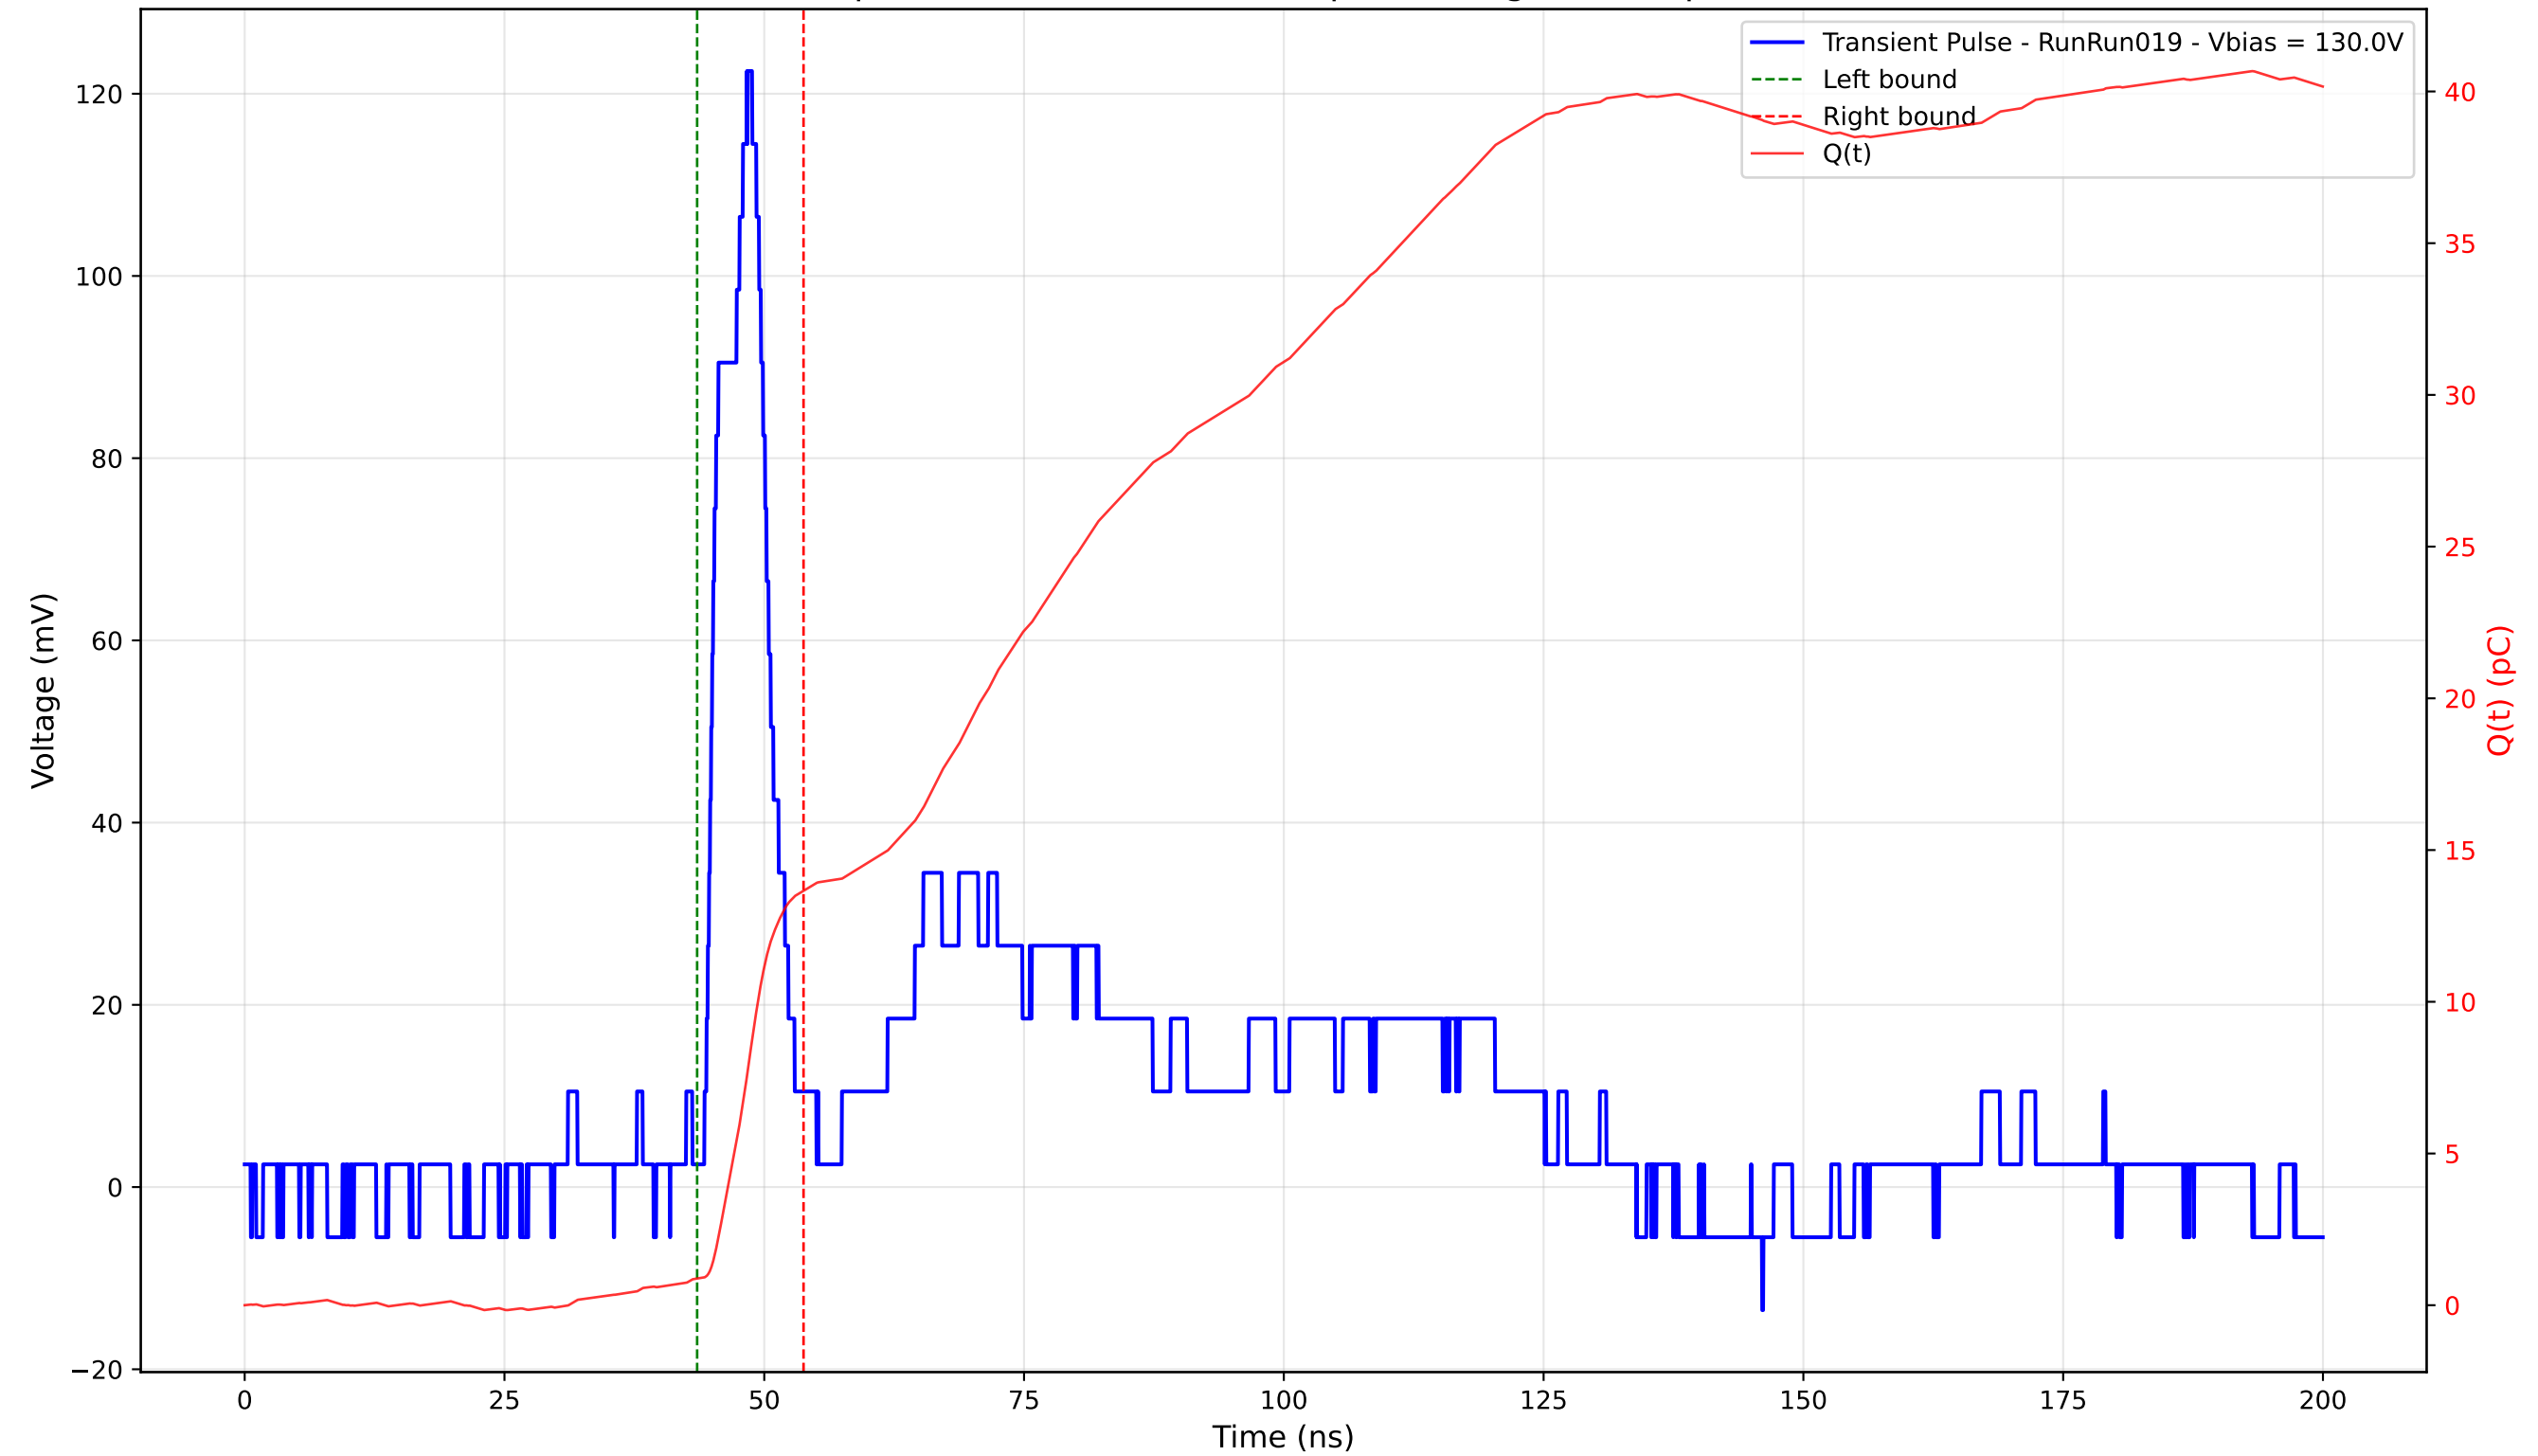


Transient Pulse - Sample: 4003 - Position: 285.0 μm - Charge: 28.85 pC - Rise Time: 4.16 ns

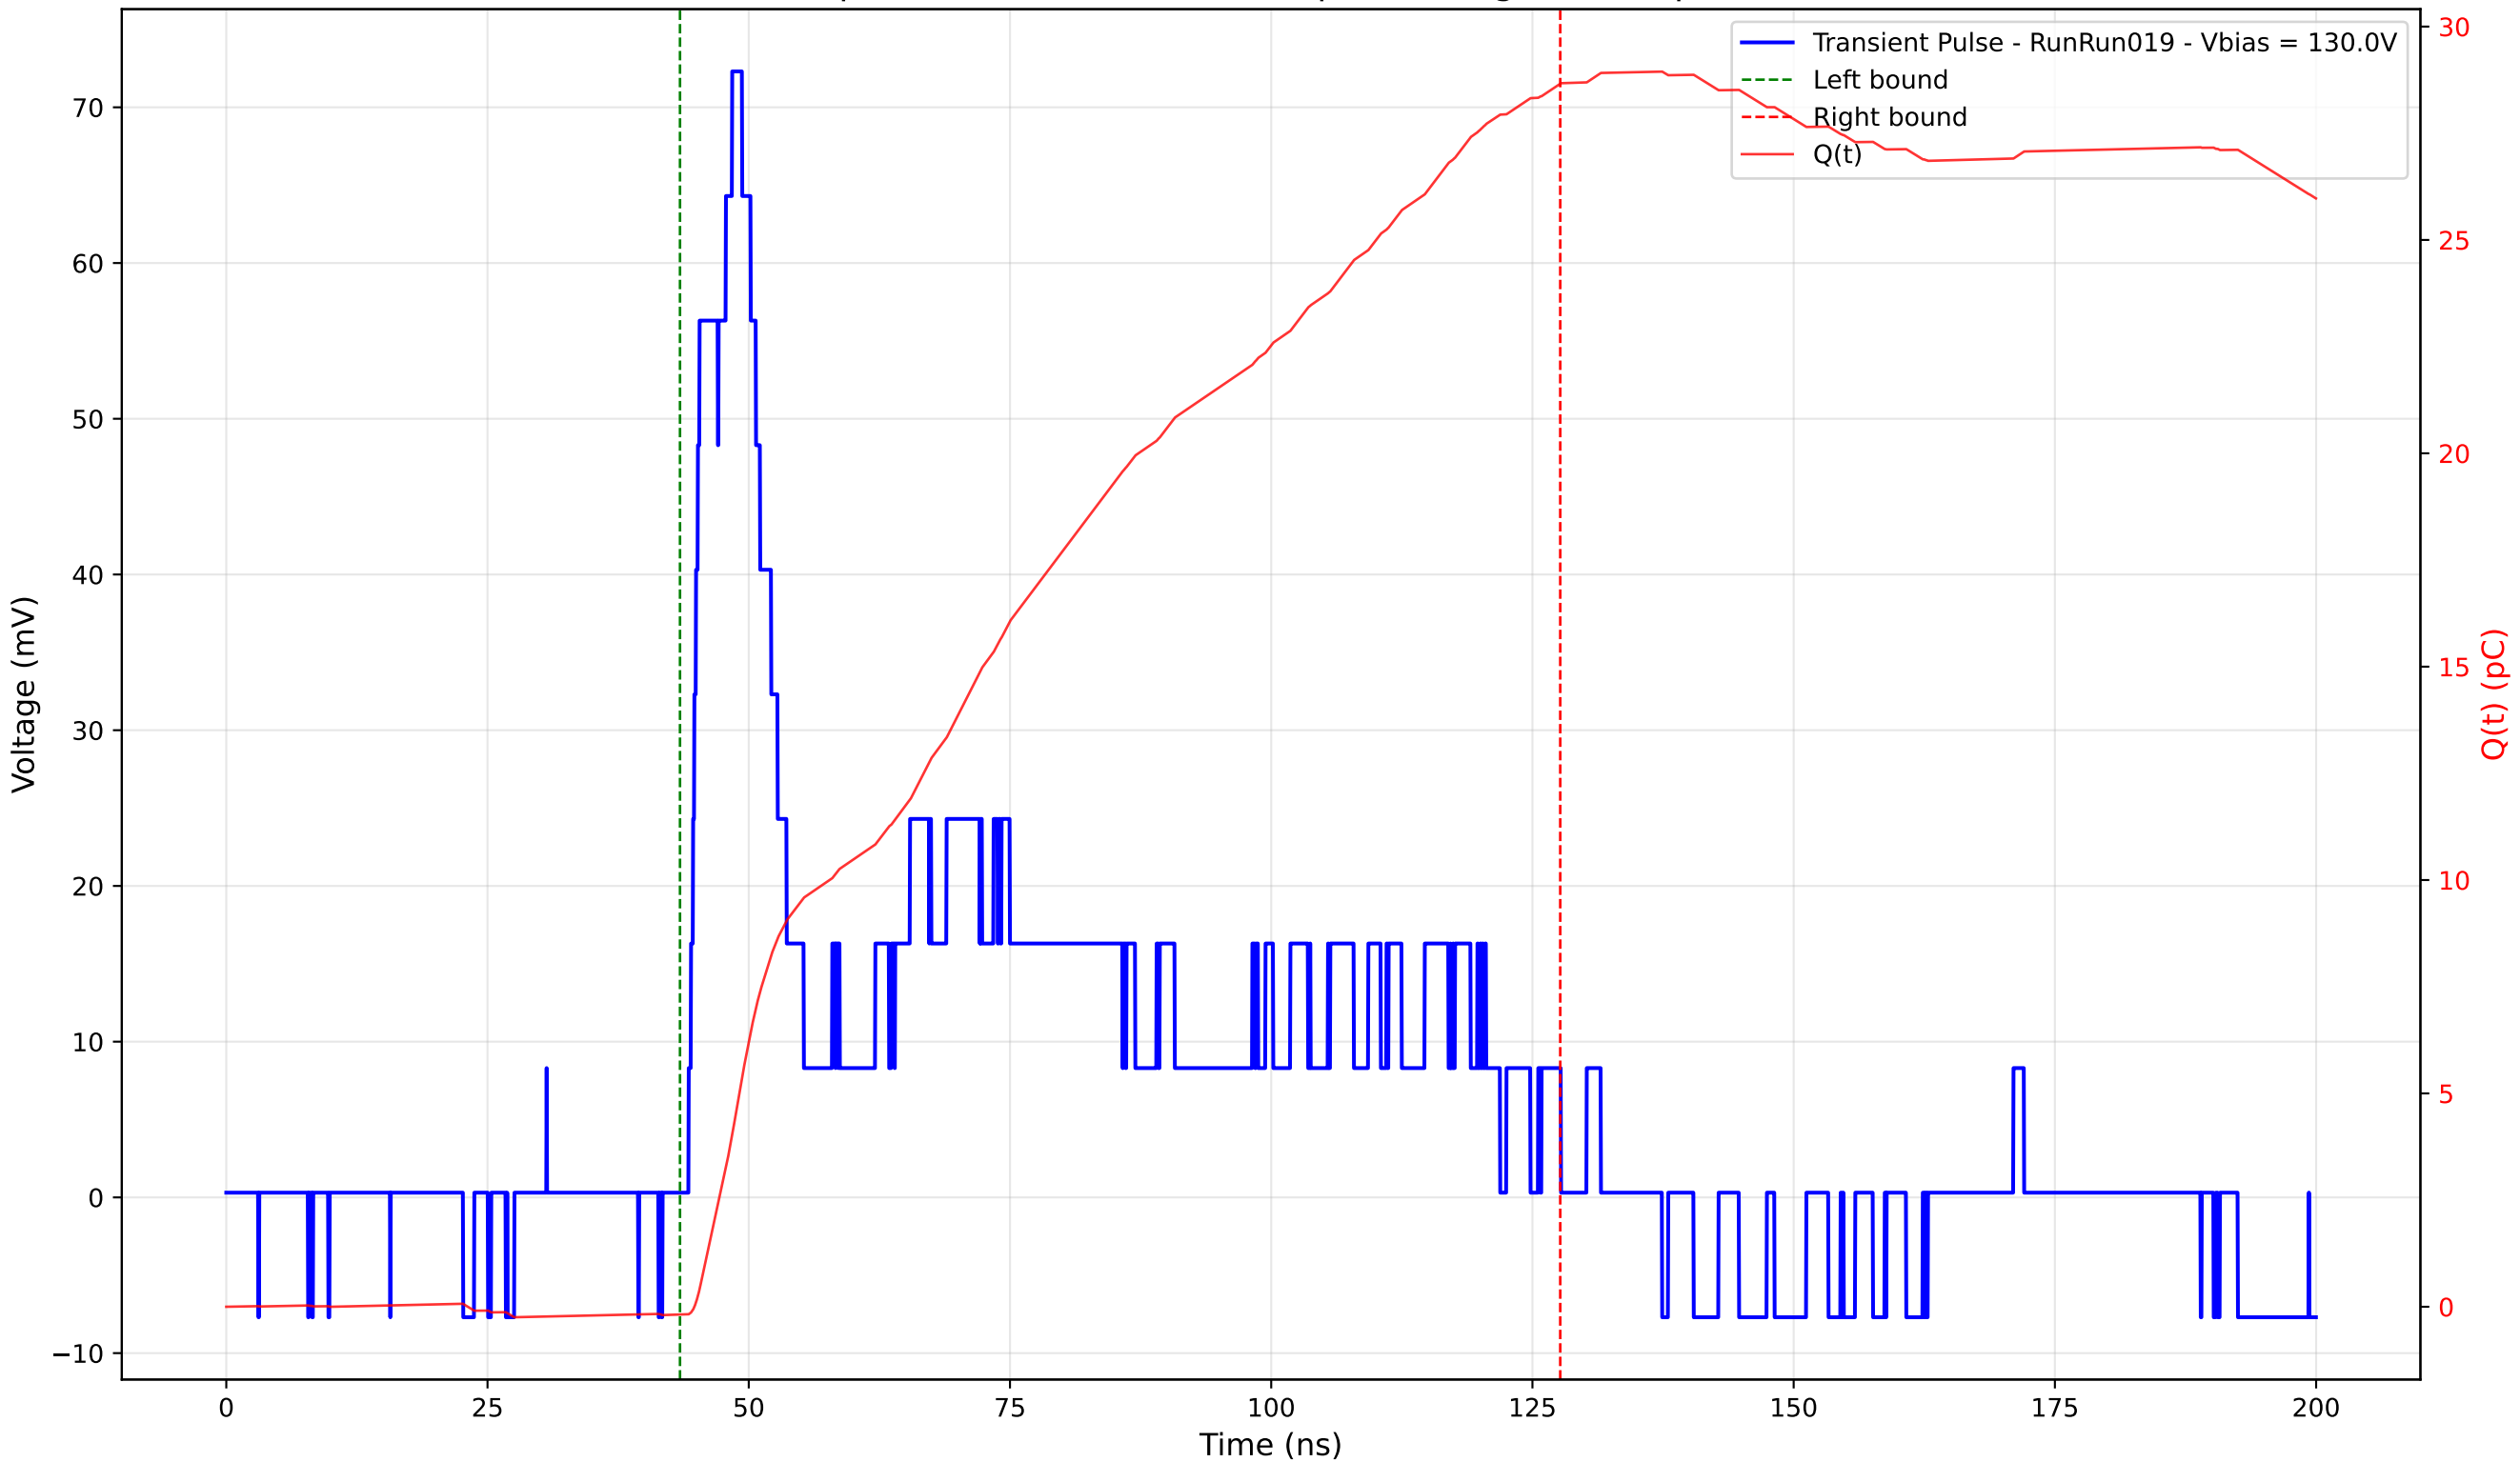


Transient Pulse - Sample: 4003 - Position: 290.0 μm - Charge: 33.27 pC - Rise Time: 1.10 ns

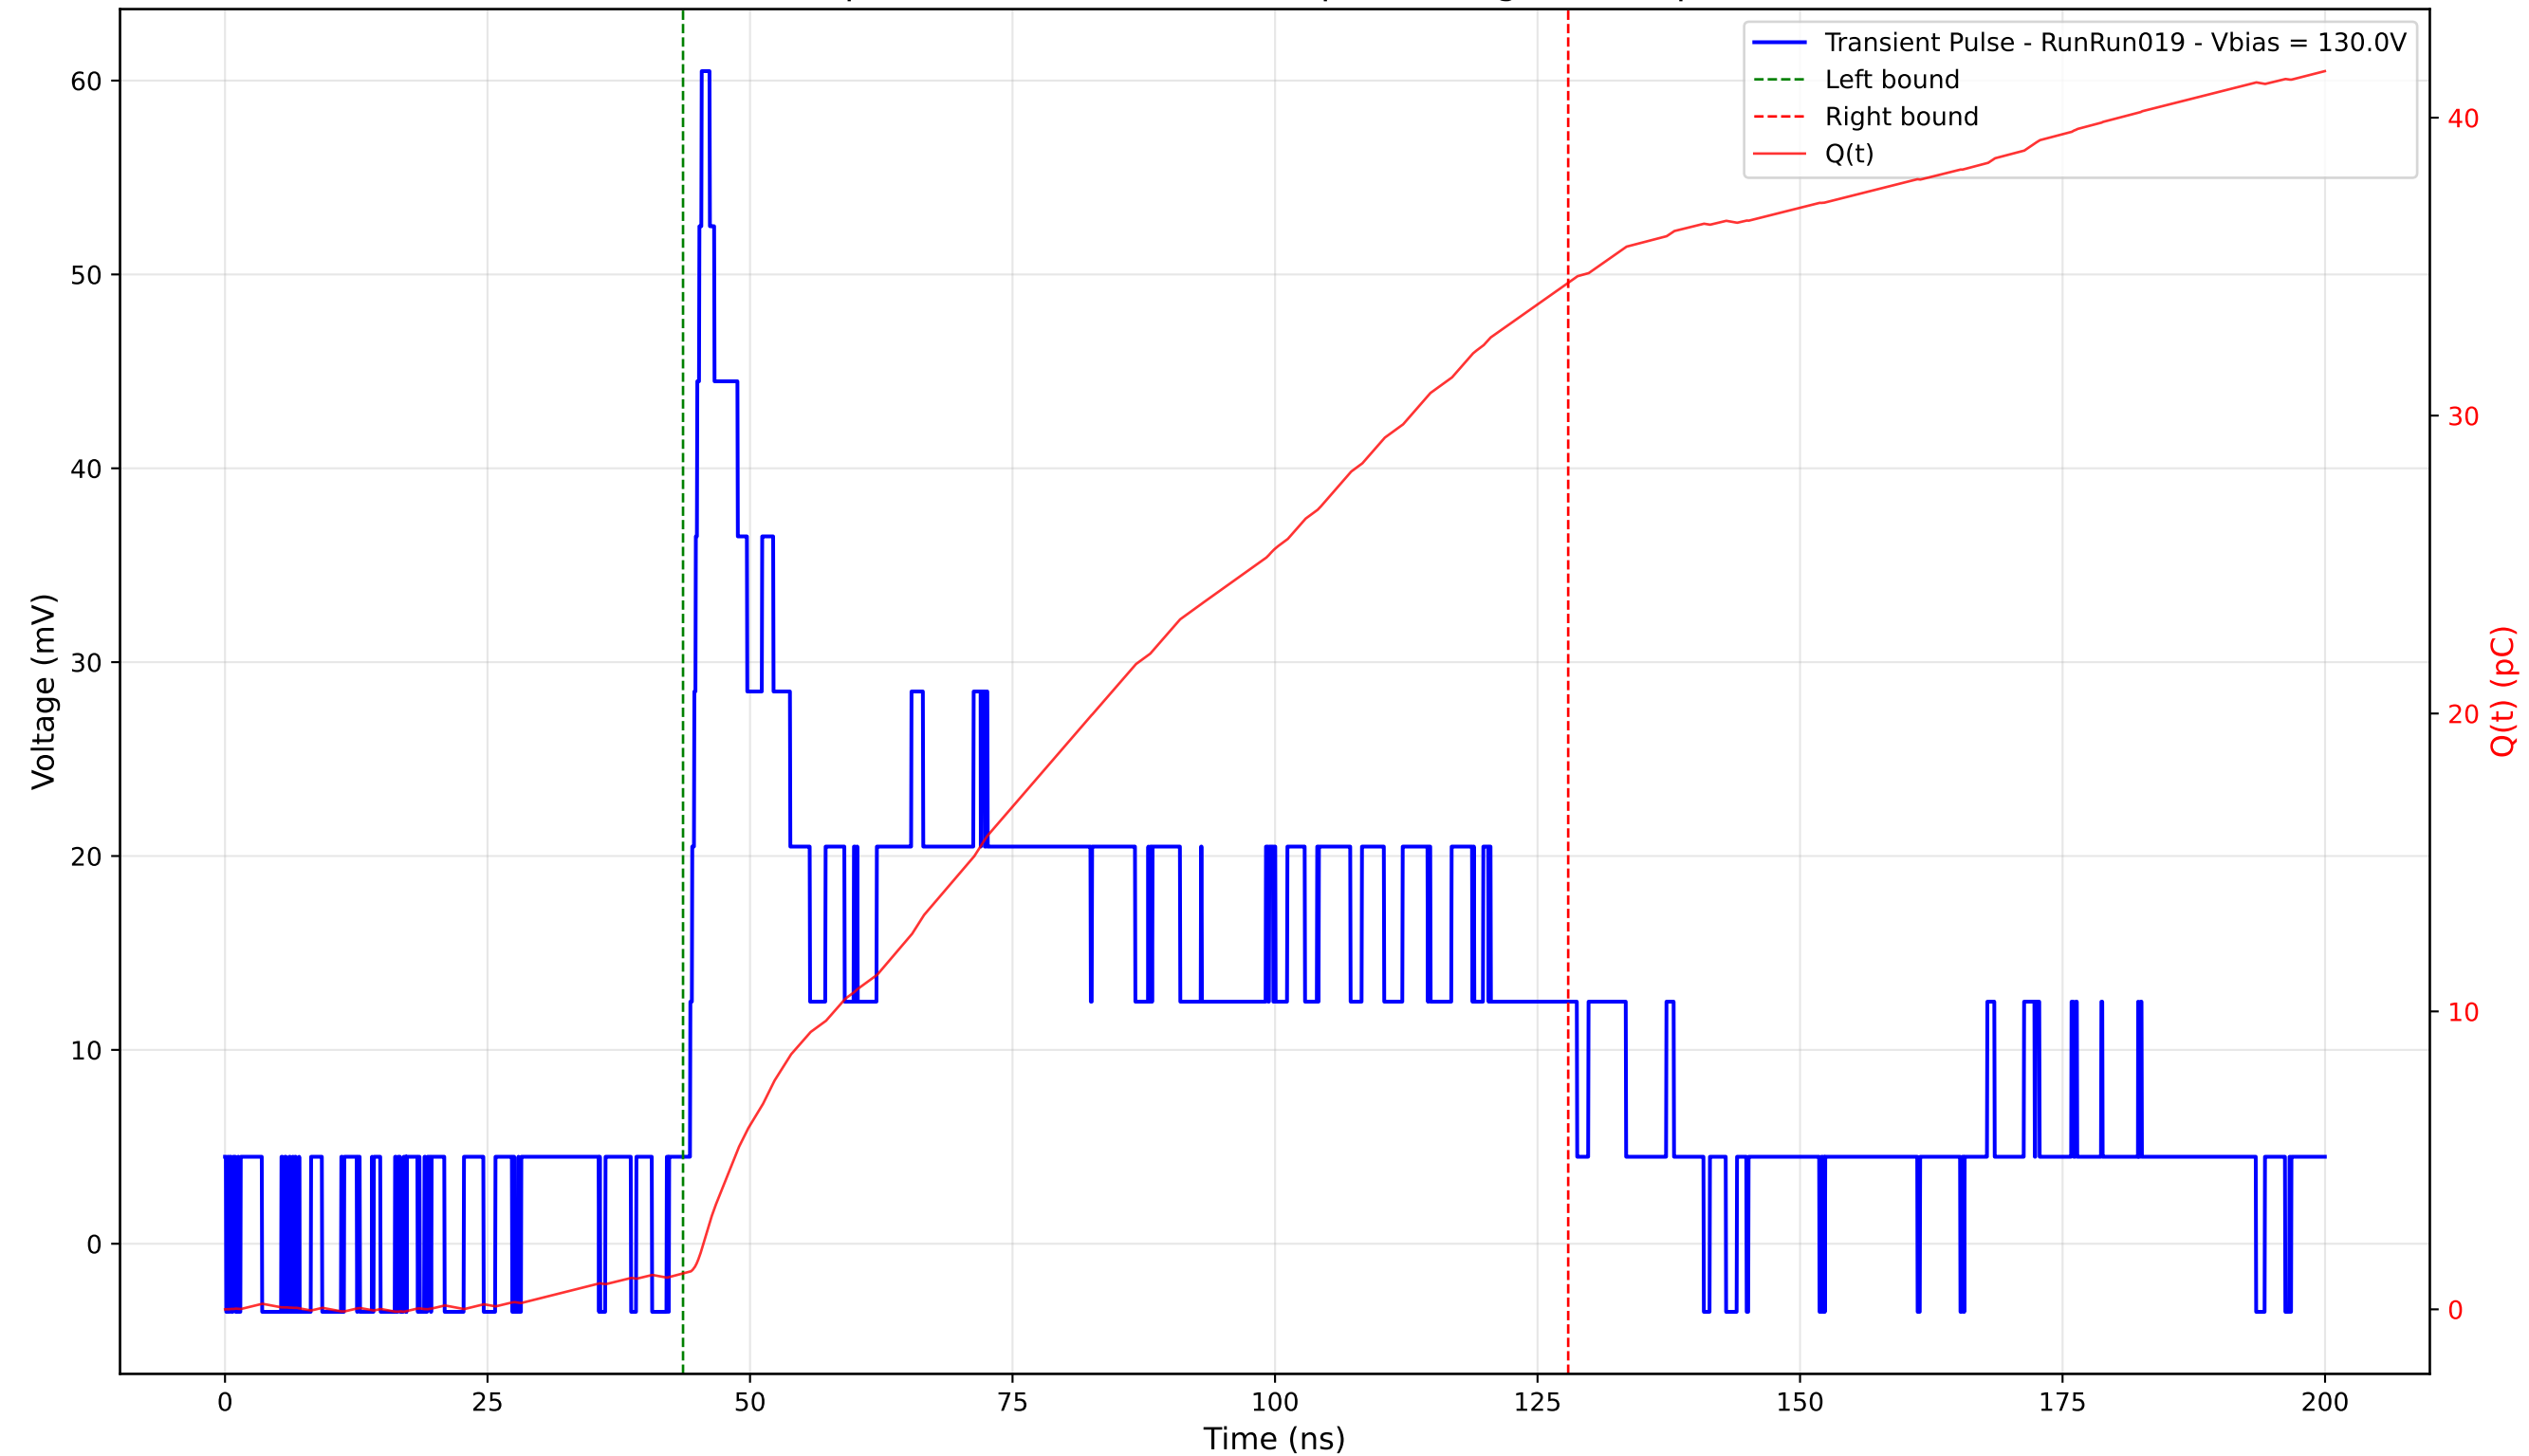


Transient Pulse - Sample: 4003 - Position: 295.0 μm - Charge: 5.81 pC - Rise Time: 1.10 ns

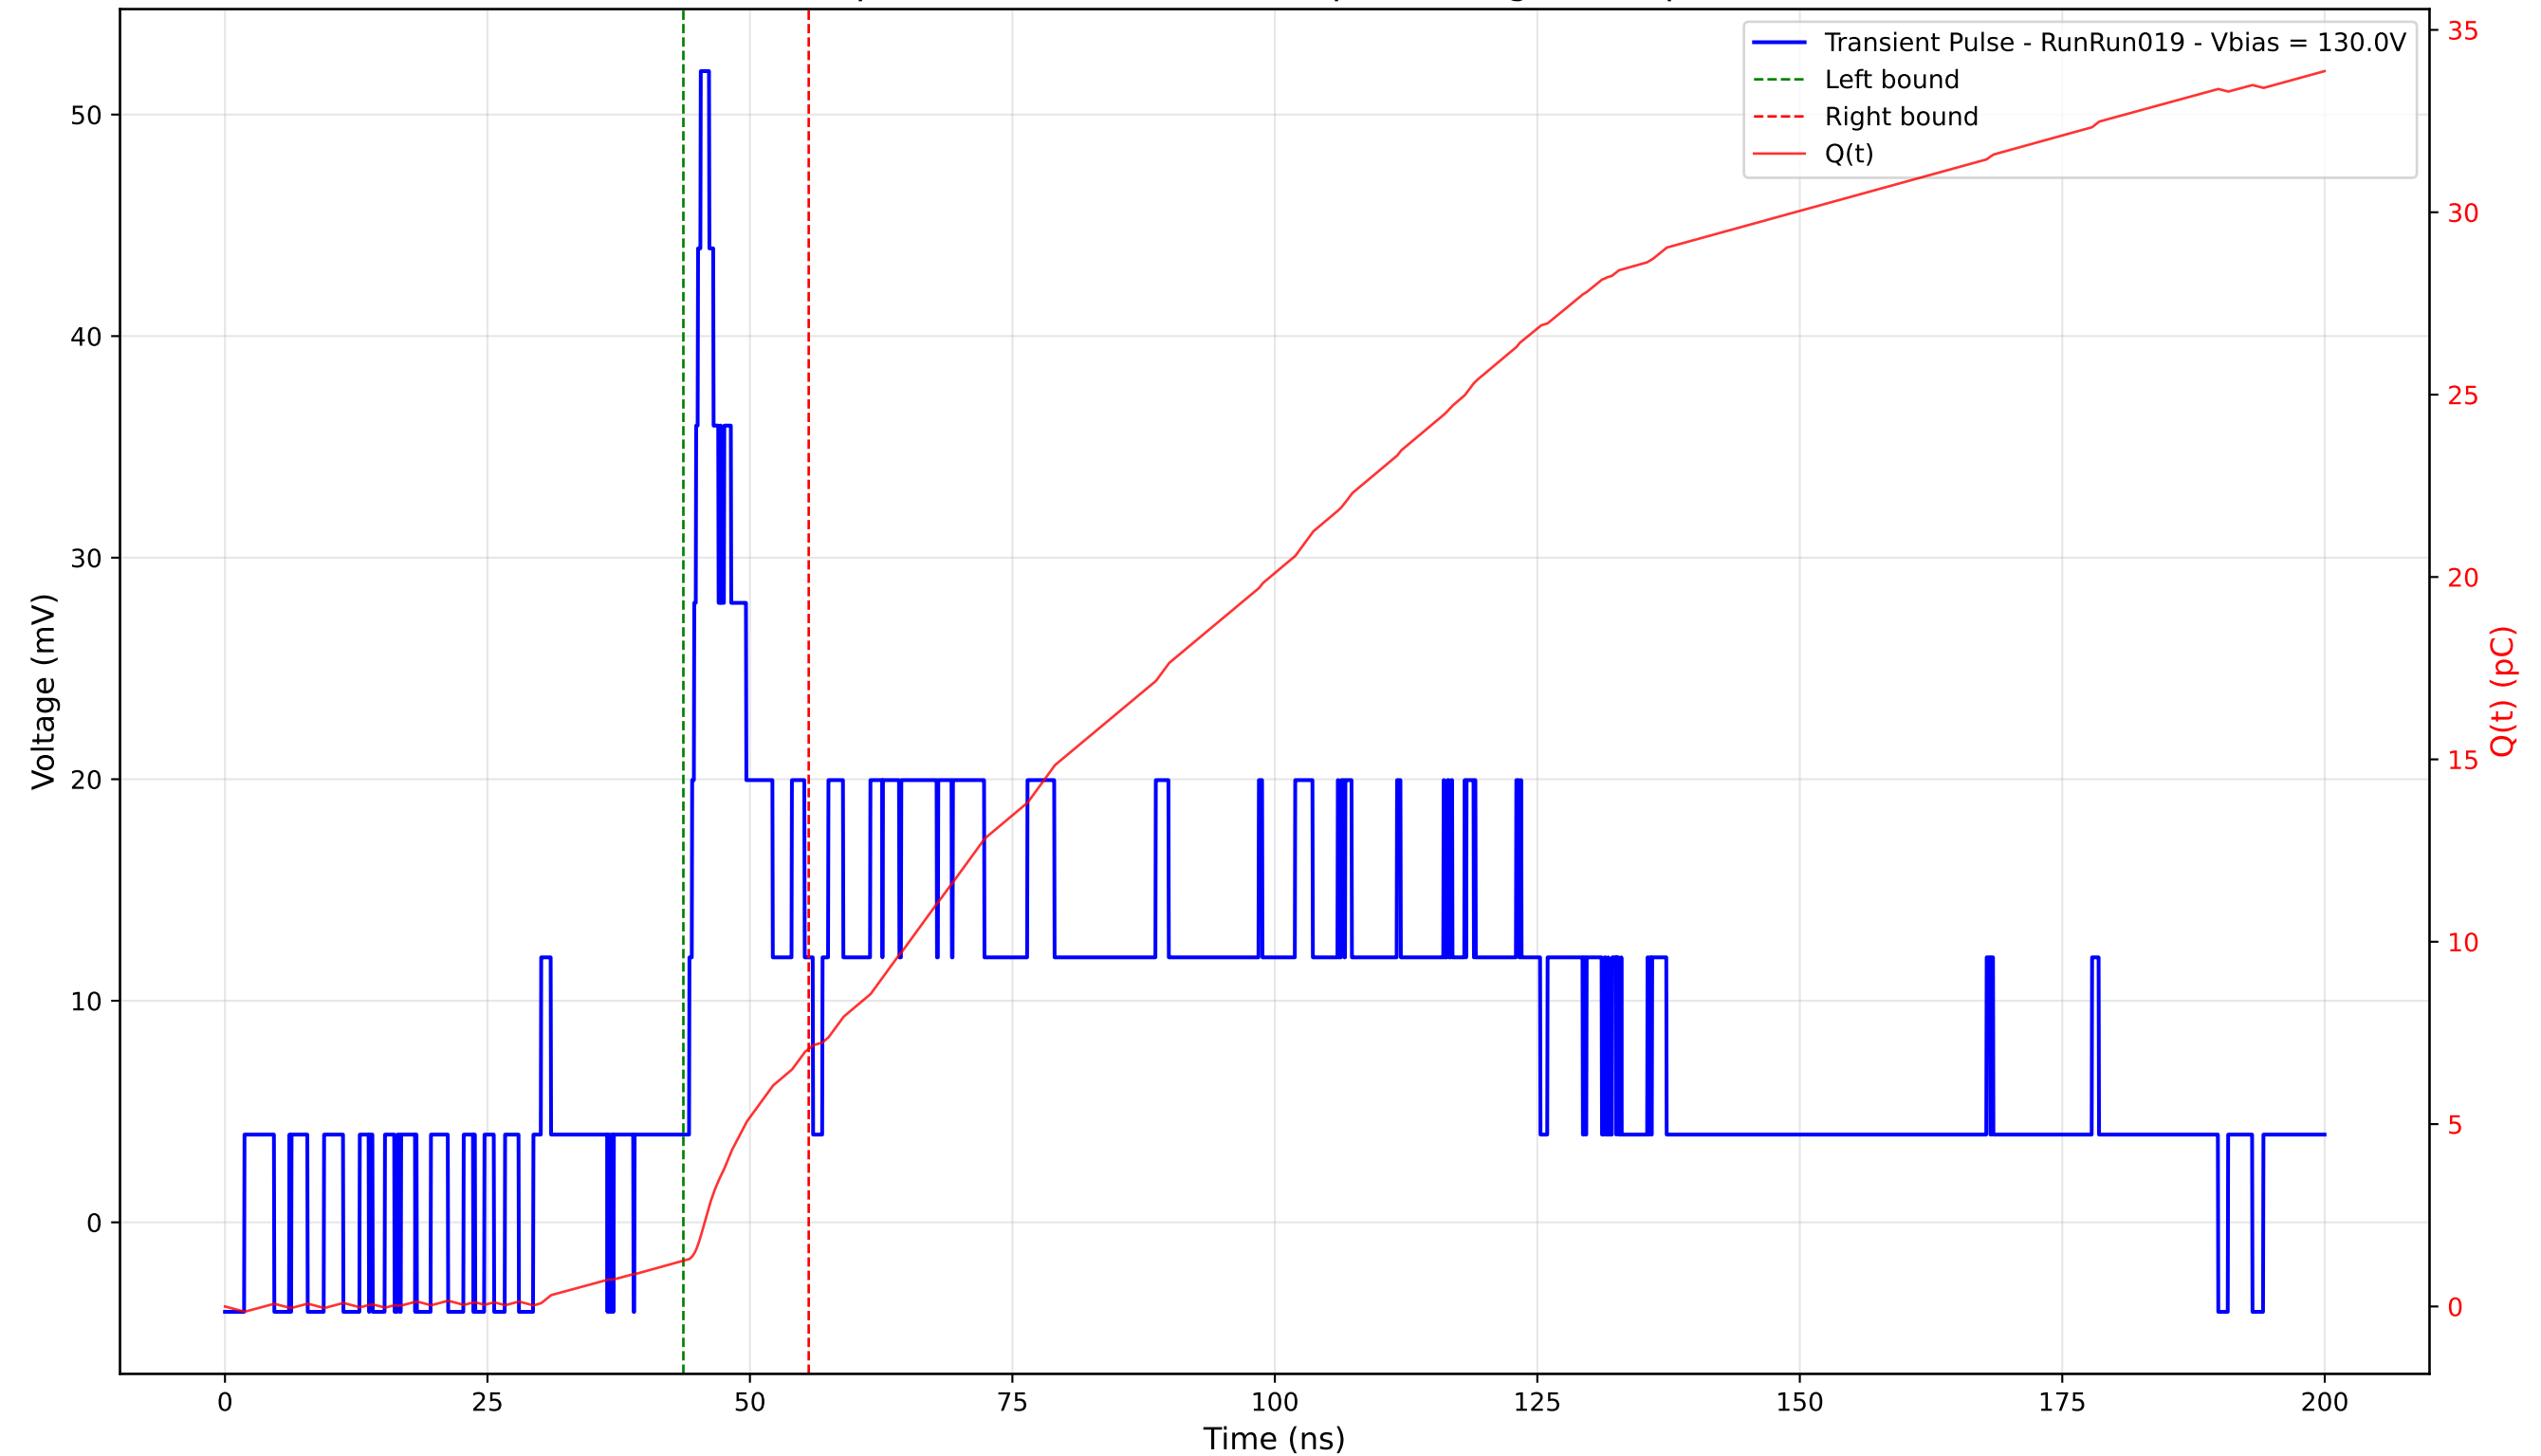


Transient Pulse - Sample: 4003 - Position: 300.0 μm - Charge: 5.02 pC - Rise Time: 1.10 ns

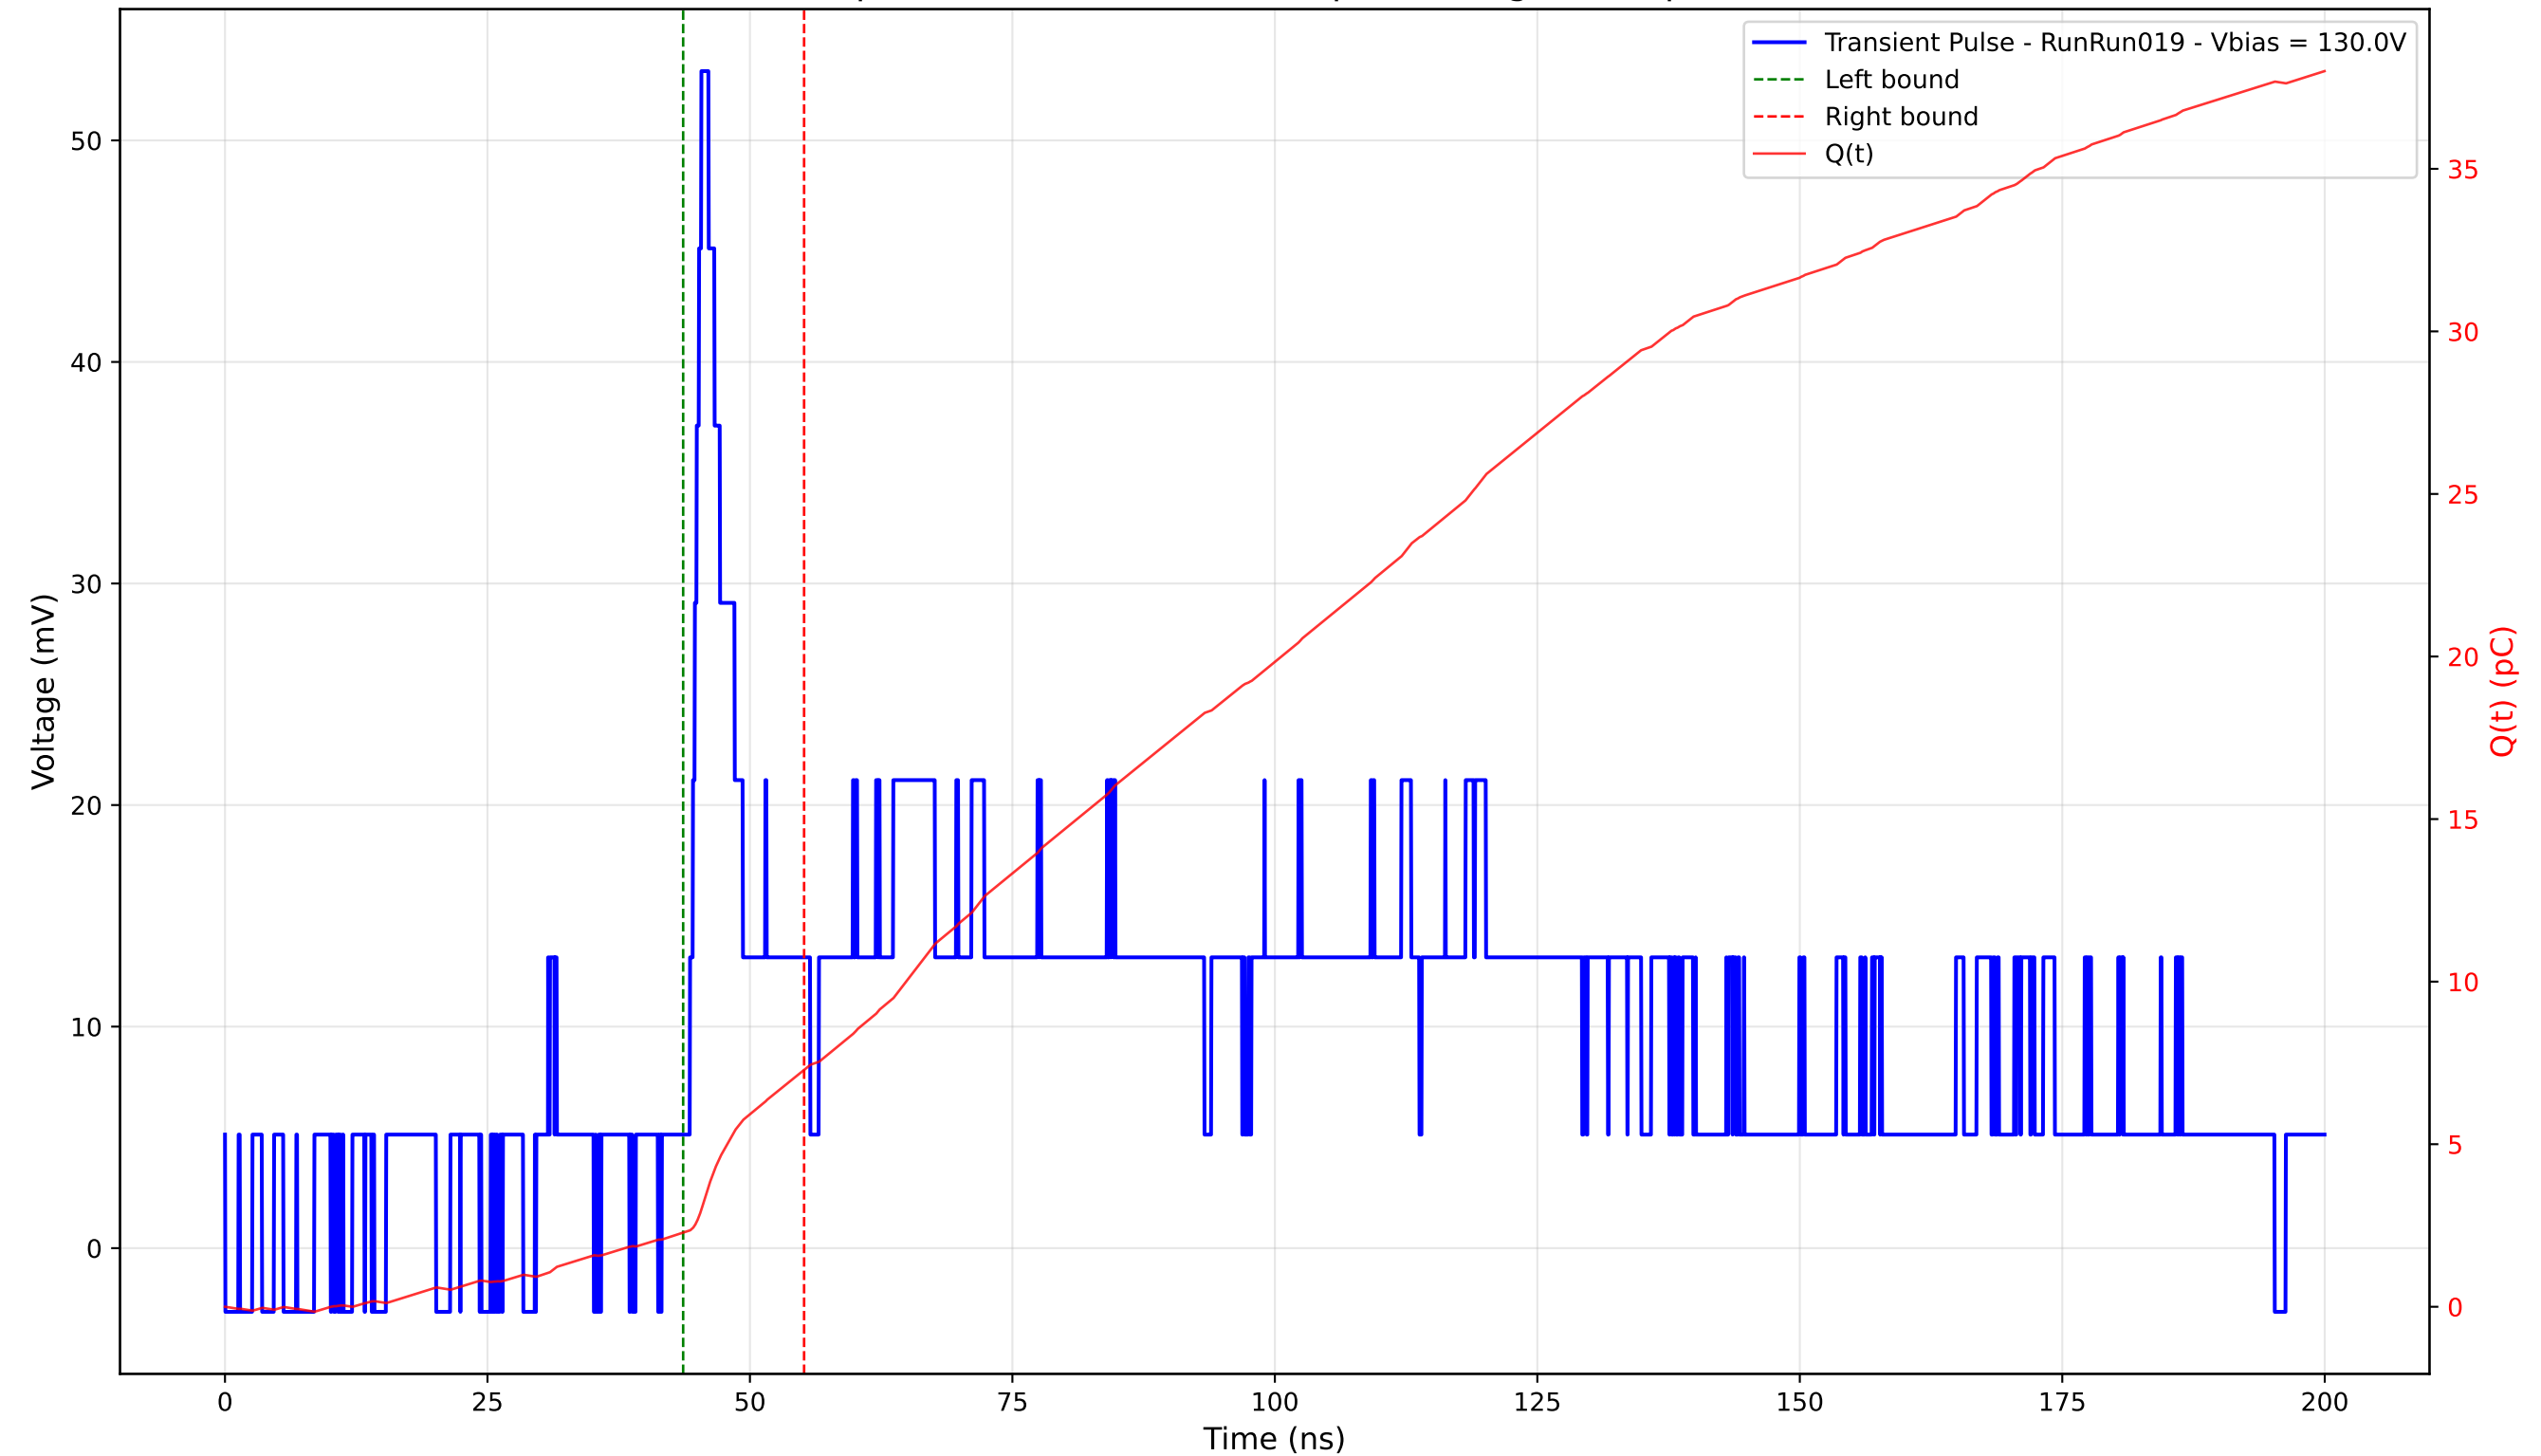


Transient Pulse - Sample: 4003 - Position: 305.0 μm - Charge: 3.38 pC - Rise Time: 1.05 ns

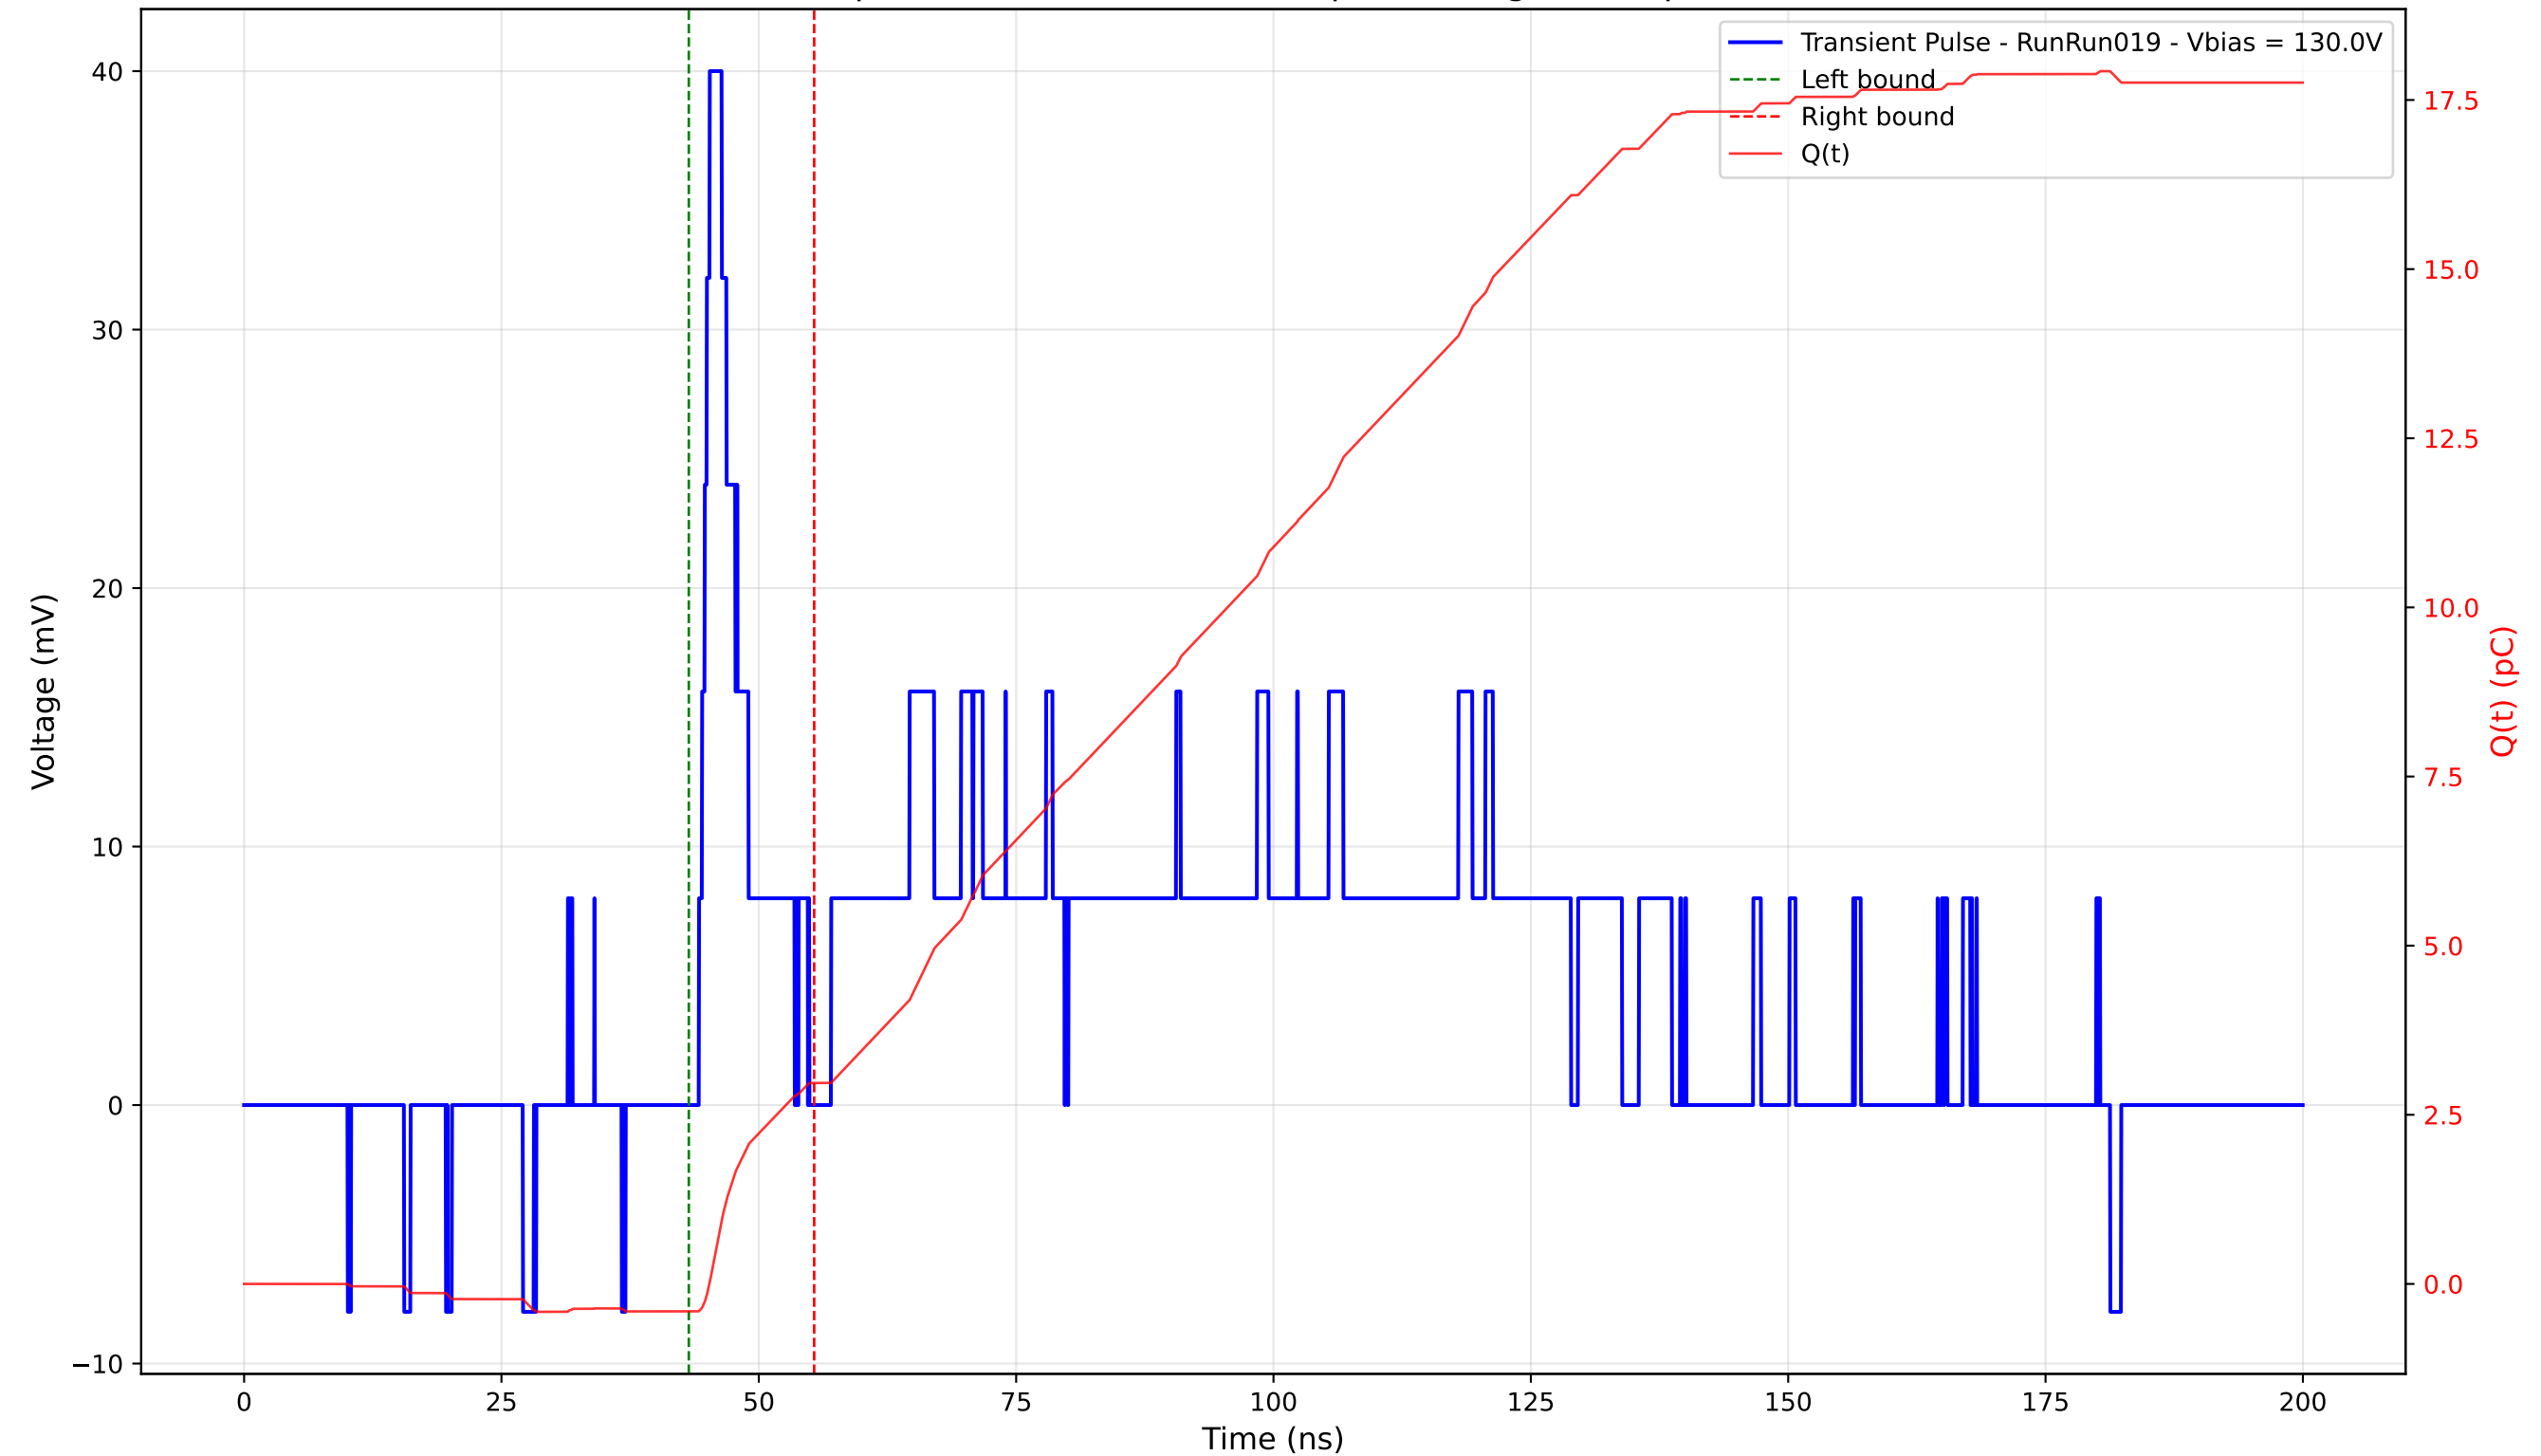


Transient Pulse - Sample: 4003 - Position: 310.0 μm - Charge: 2.93 pC - Rise Time: 1.08 ns

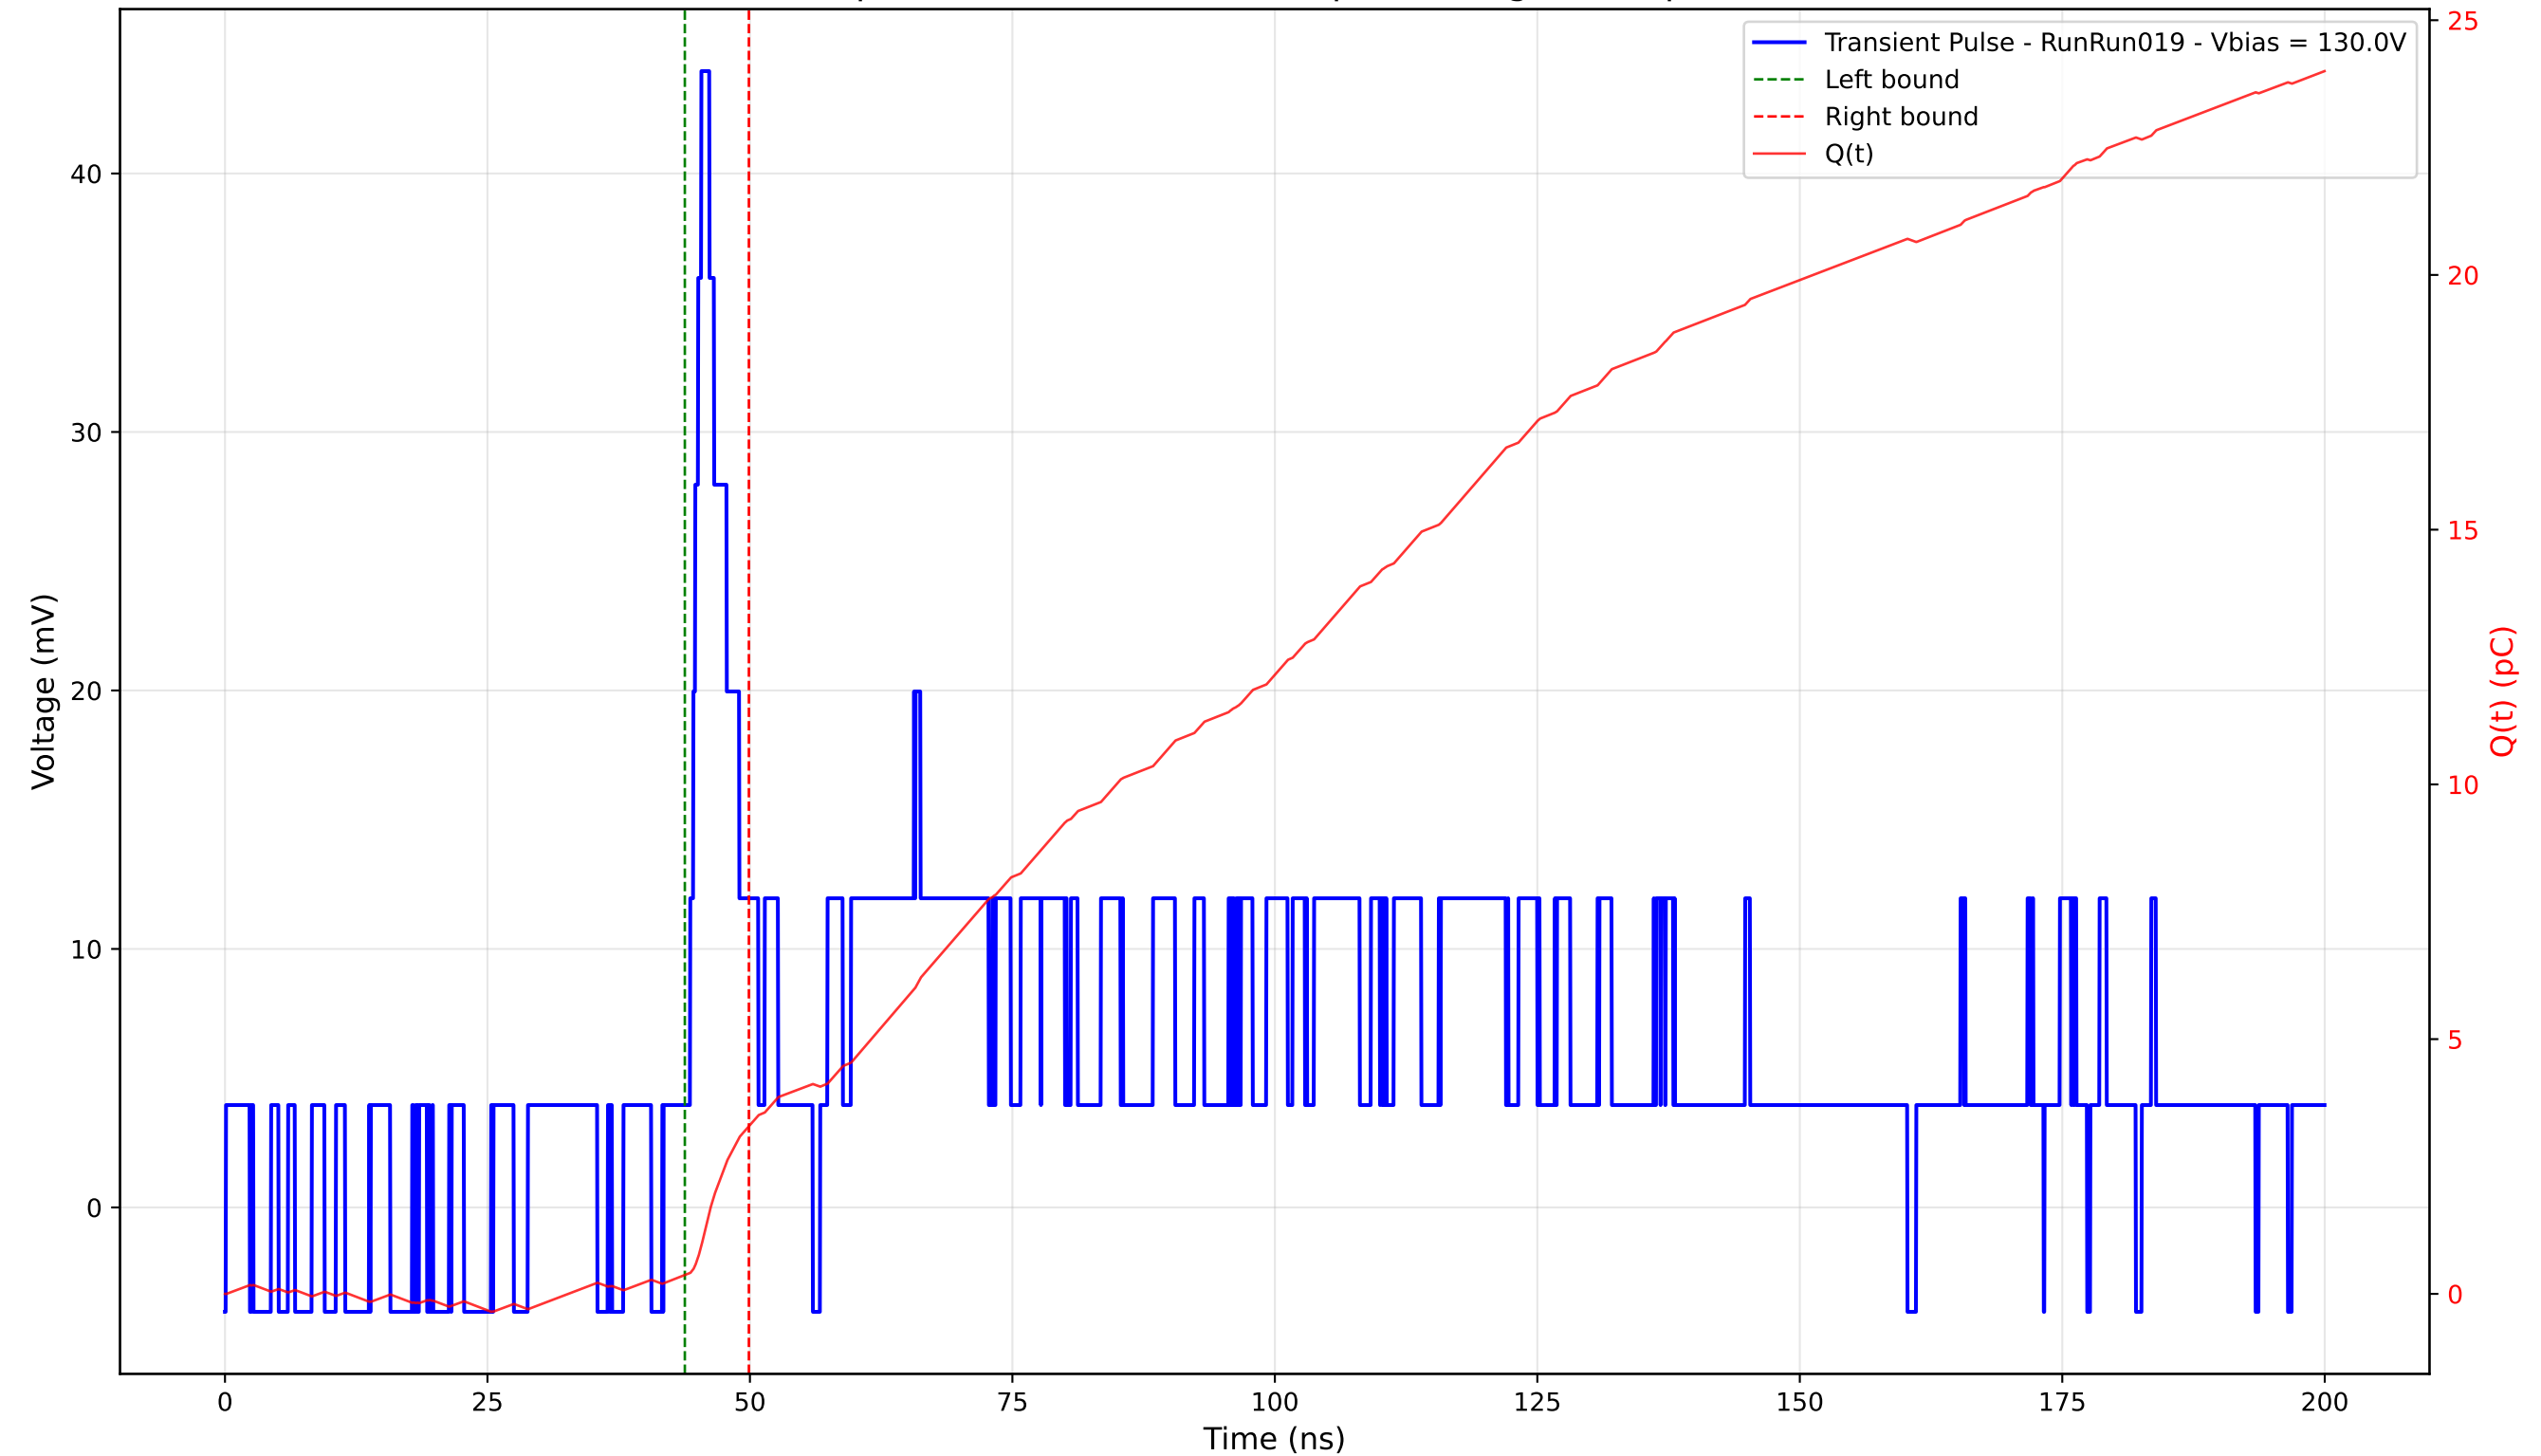


Transient Pulse - Sample: 4003 - Position: 315.0 μm - Charge: 2.23 pC - Rise Time: 0.97 ns

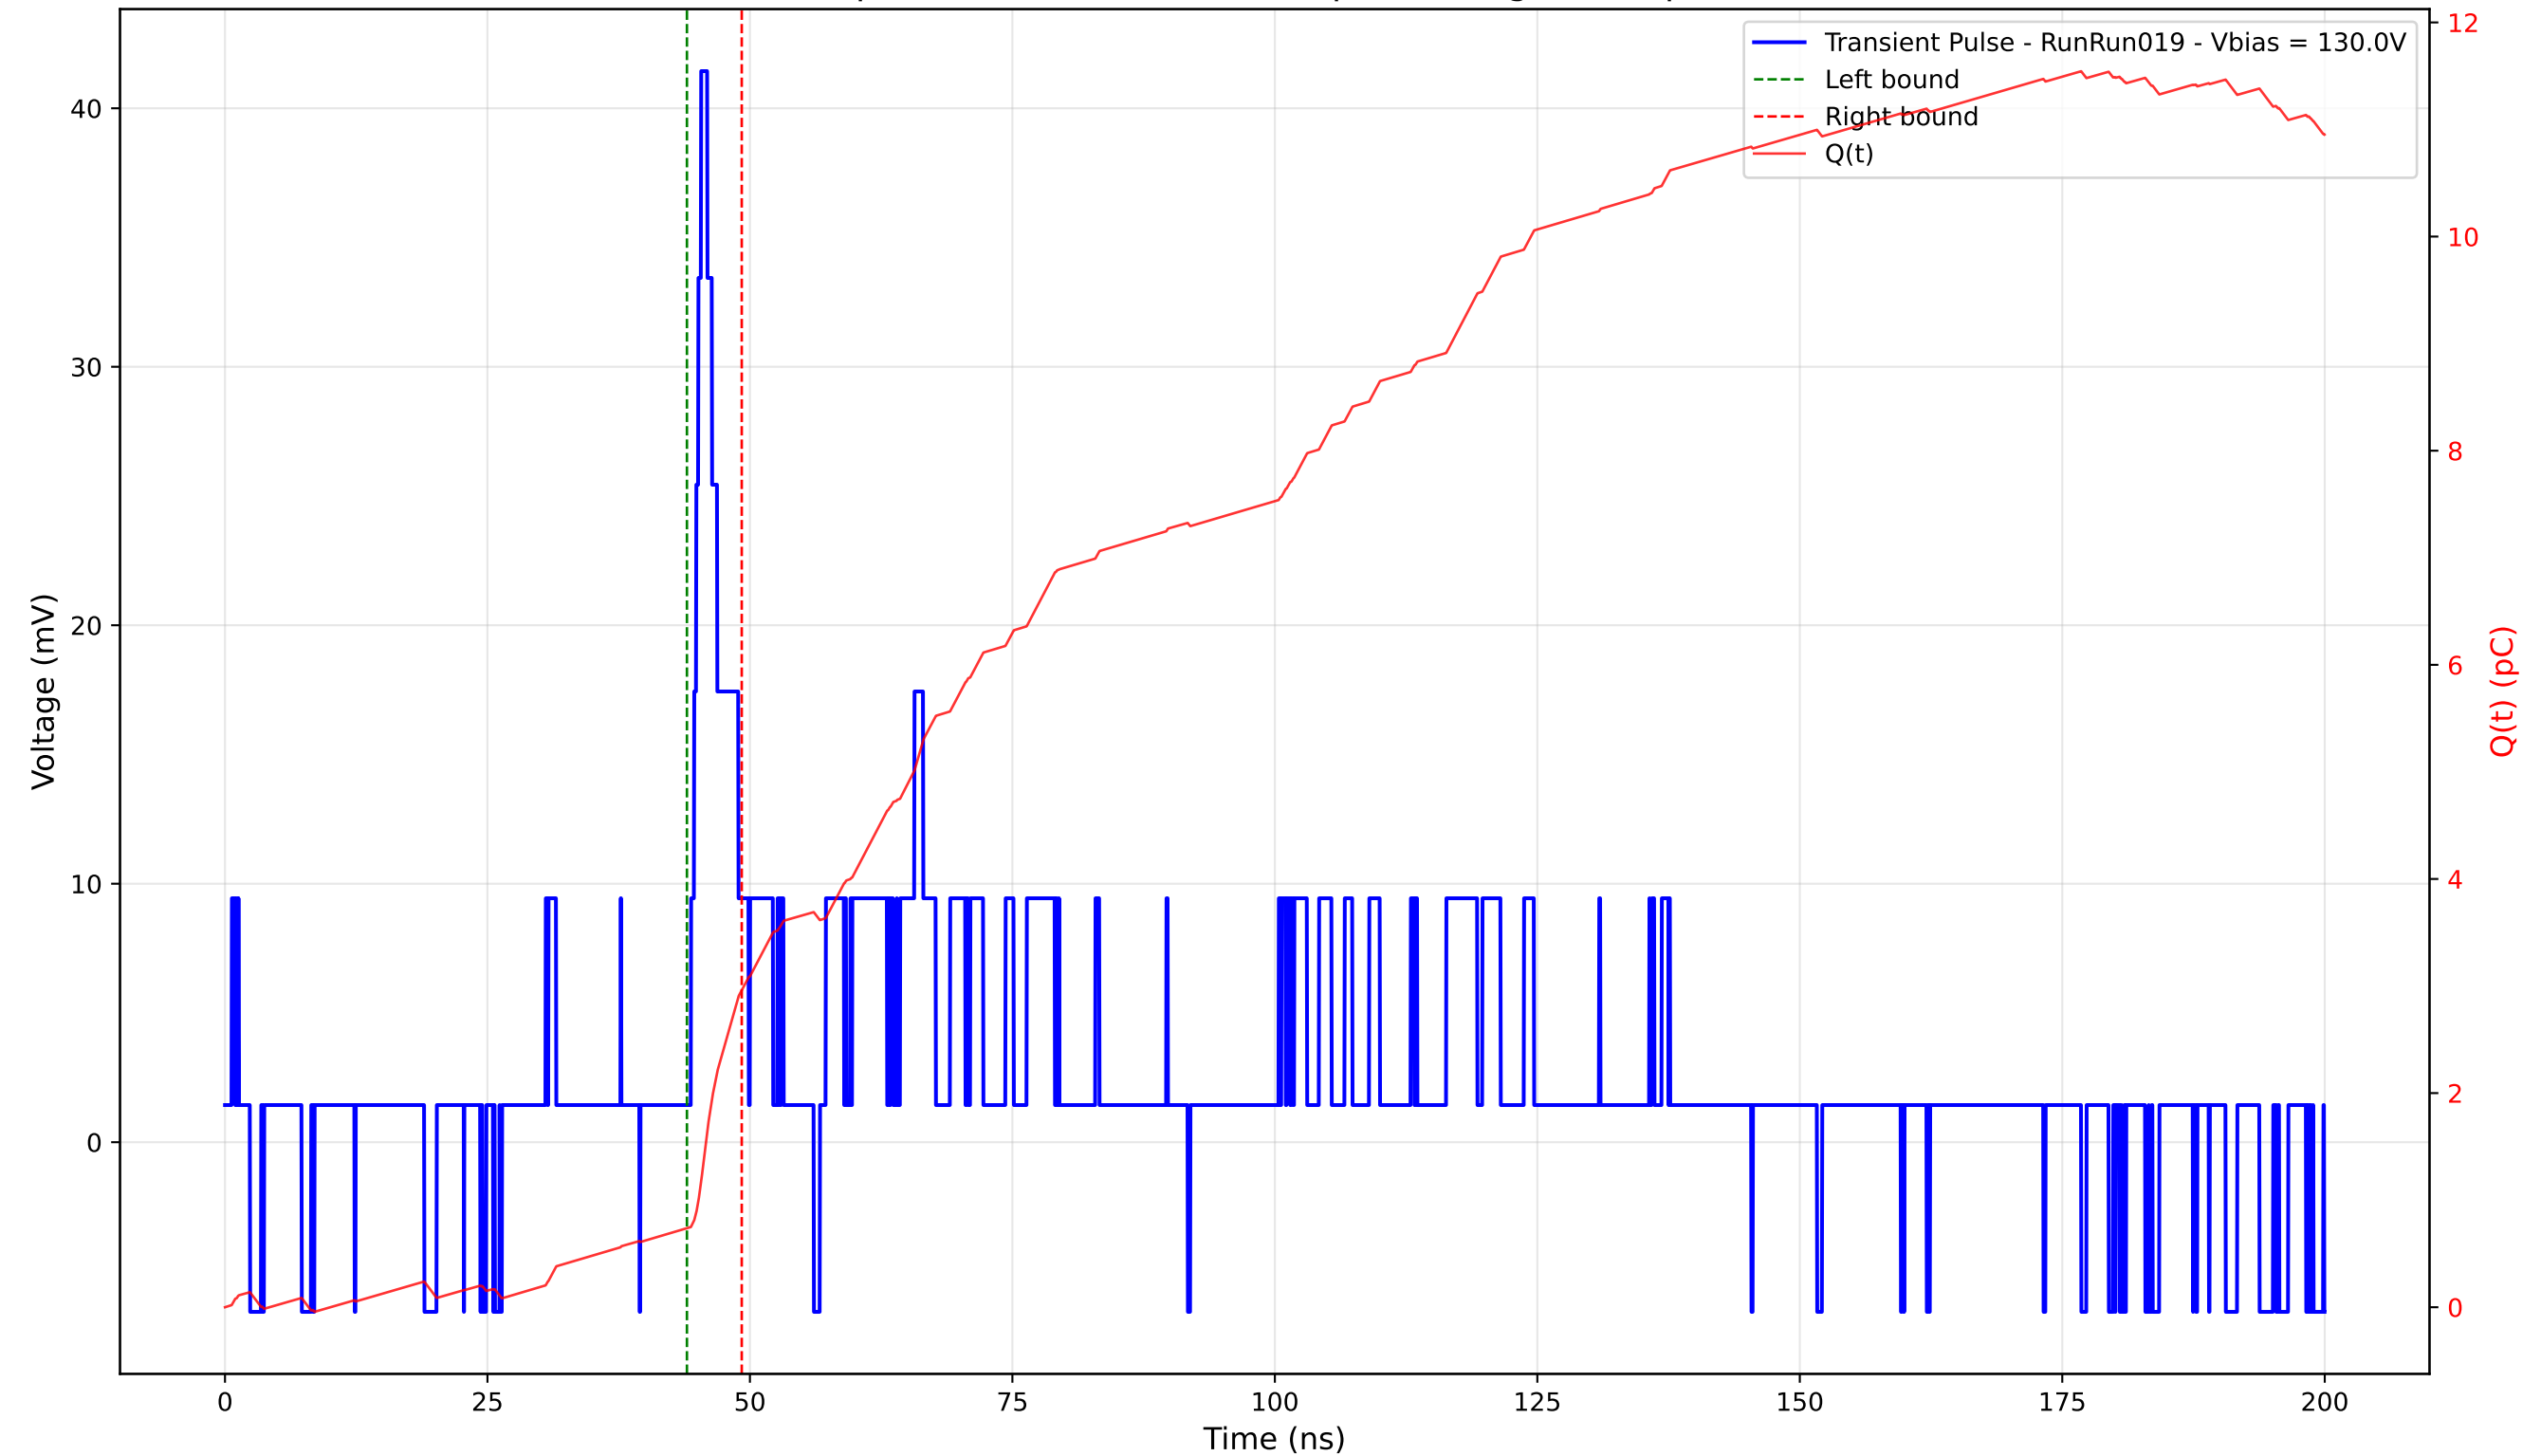


Transient Pulse - Sample: 4003 - Position: 320.0 μm - Charge: 2.43 pC - Rise Time: 0.00 ns (N/A)

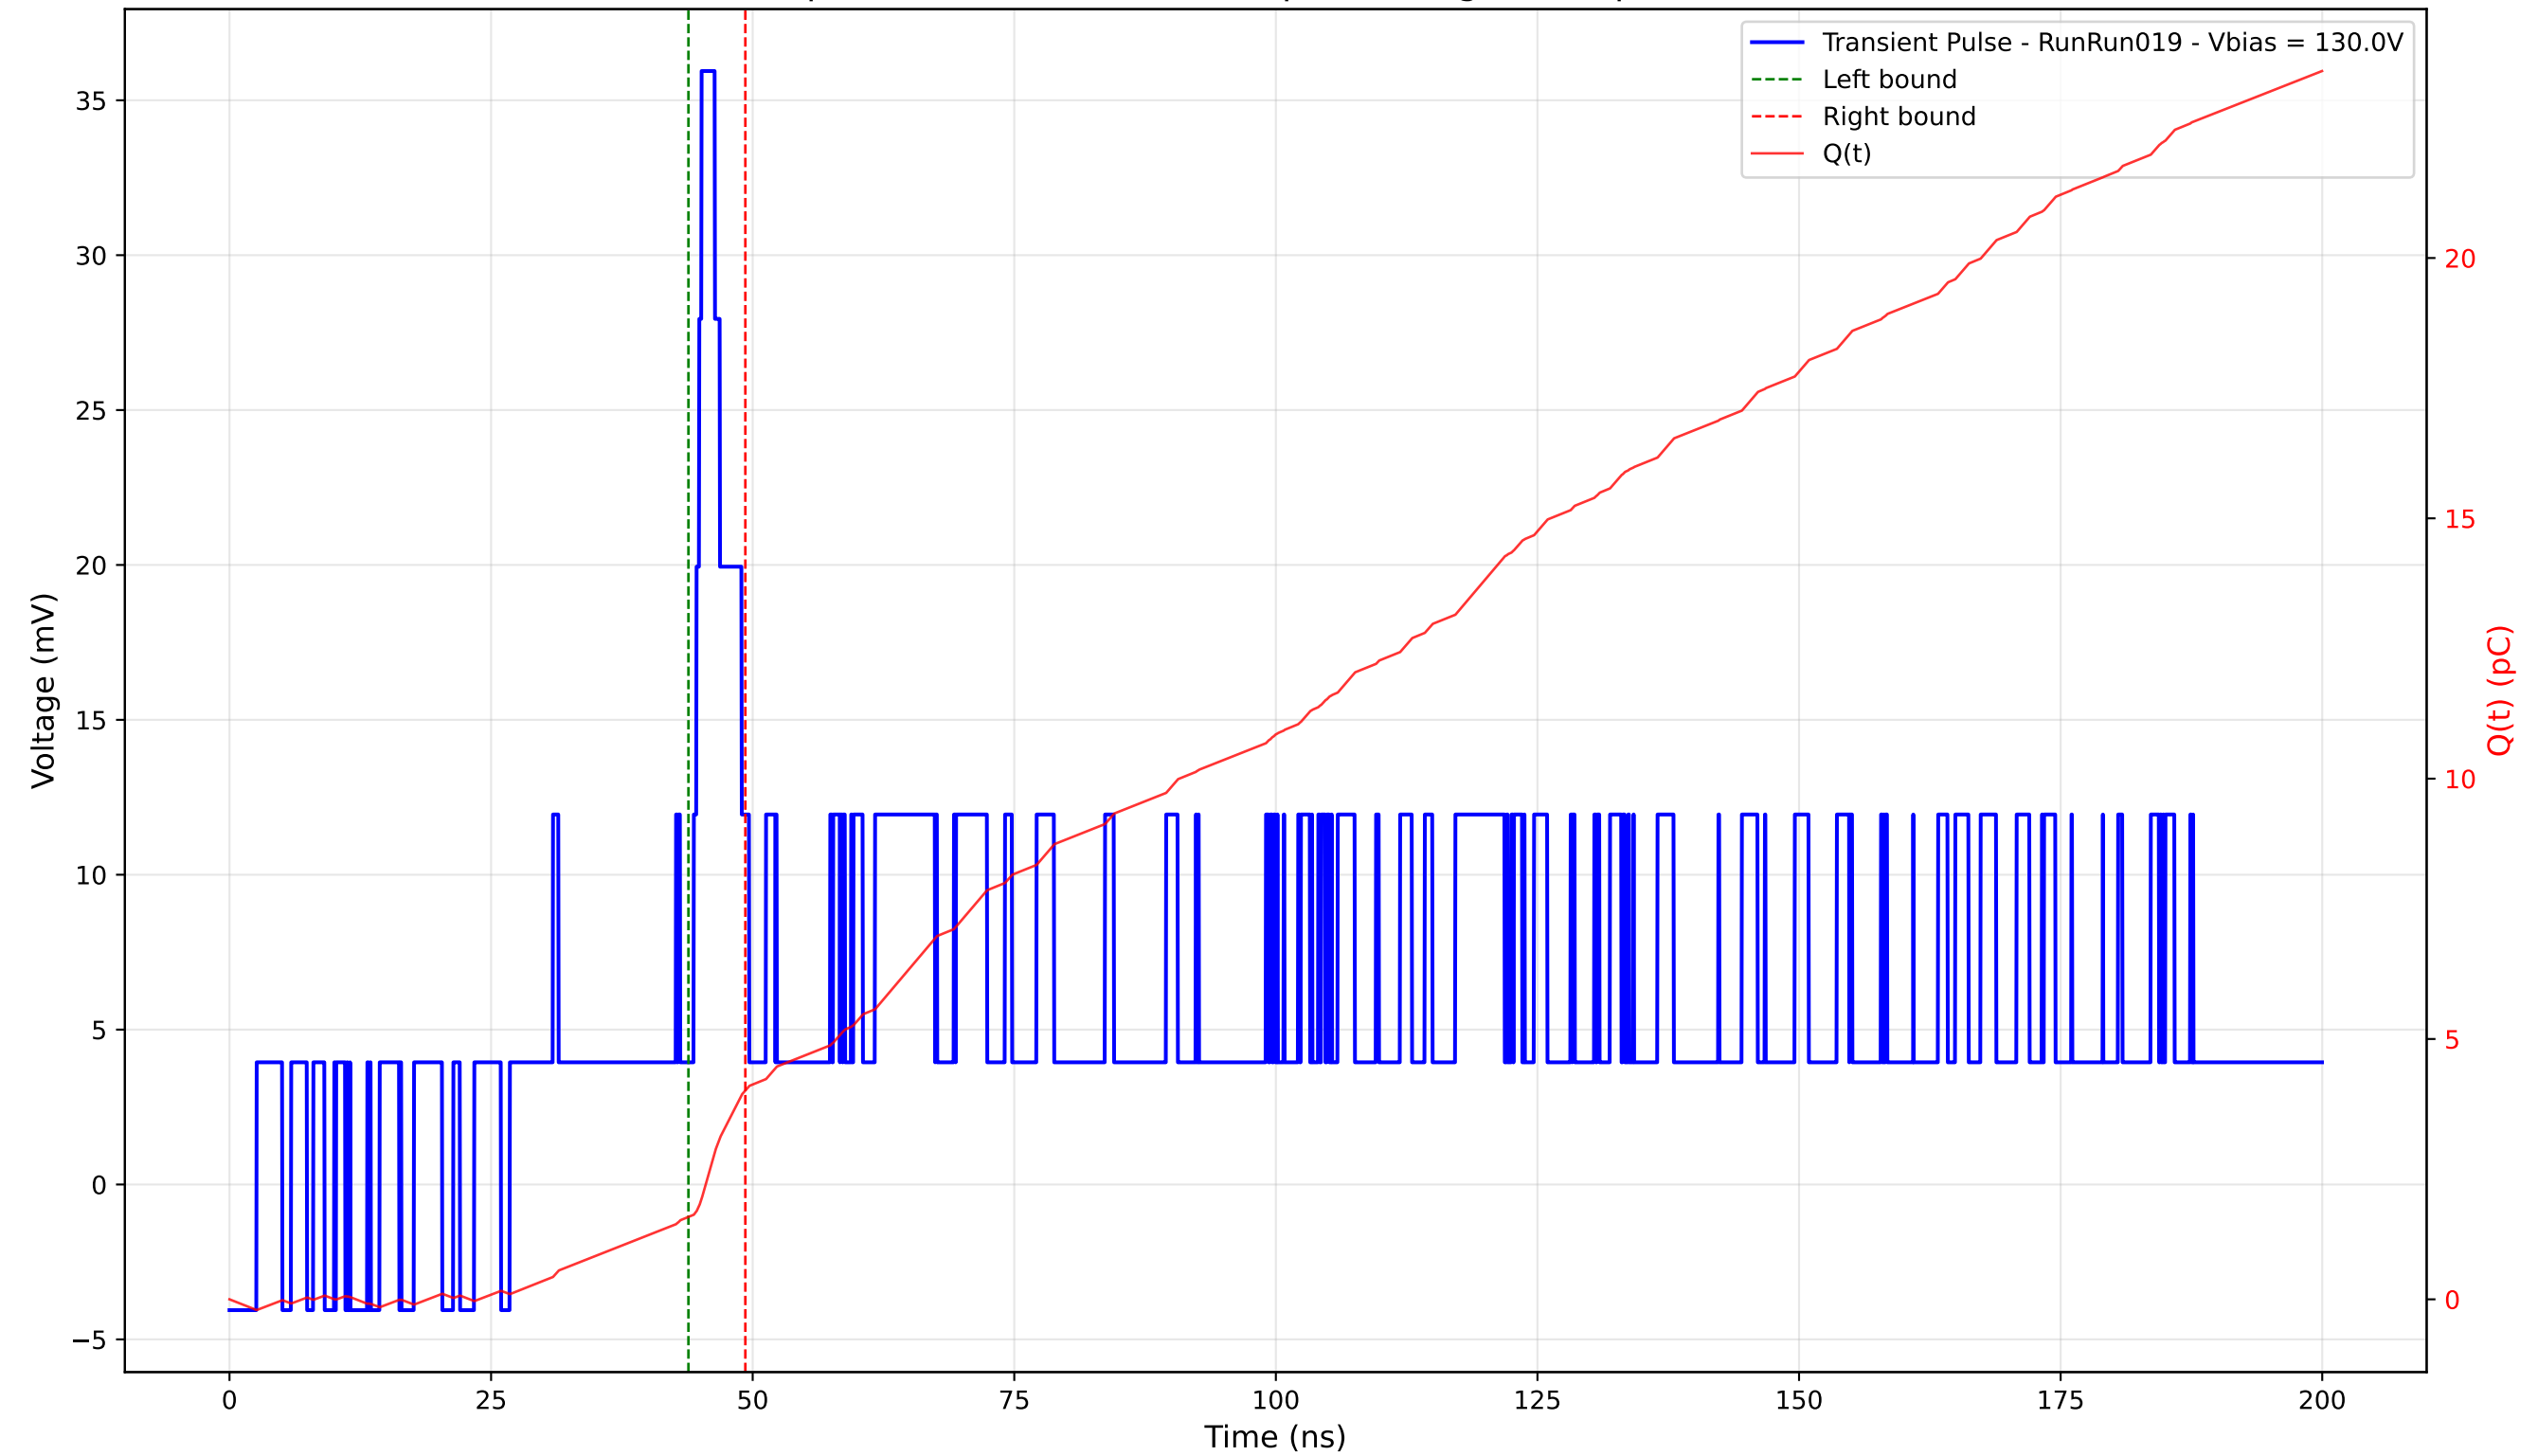


Transient Pulse - Sample: 4003 - Position: 325.0 μm - Charge: 1.69 pC - Rise Time: 0.88 ns

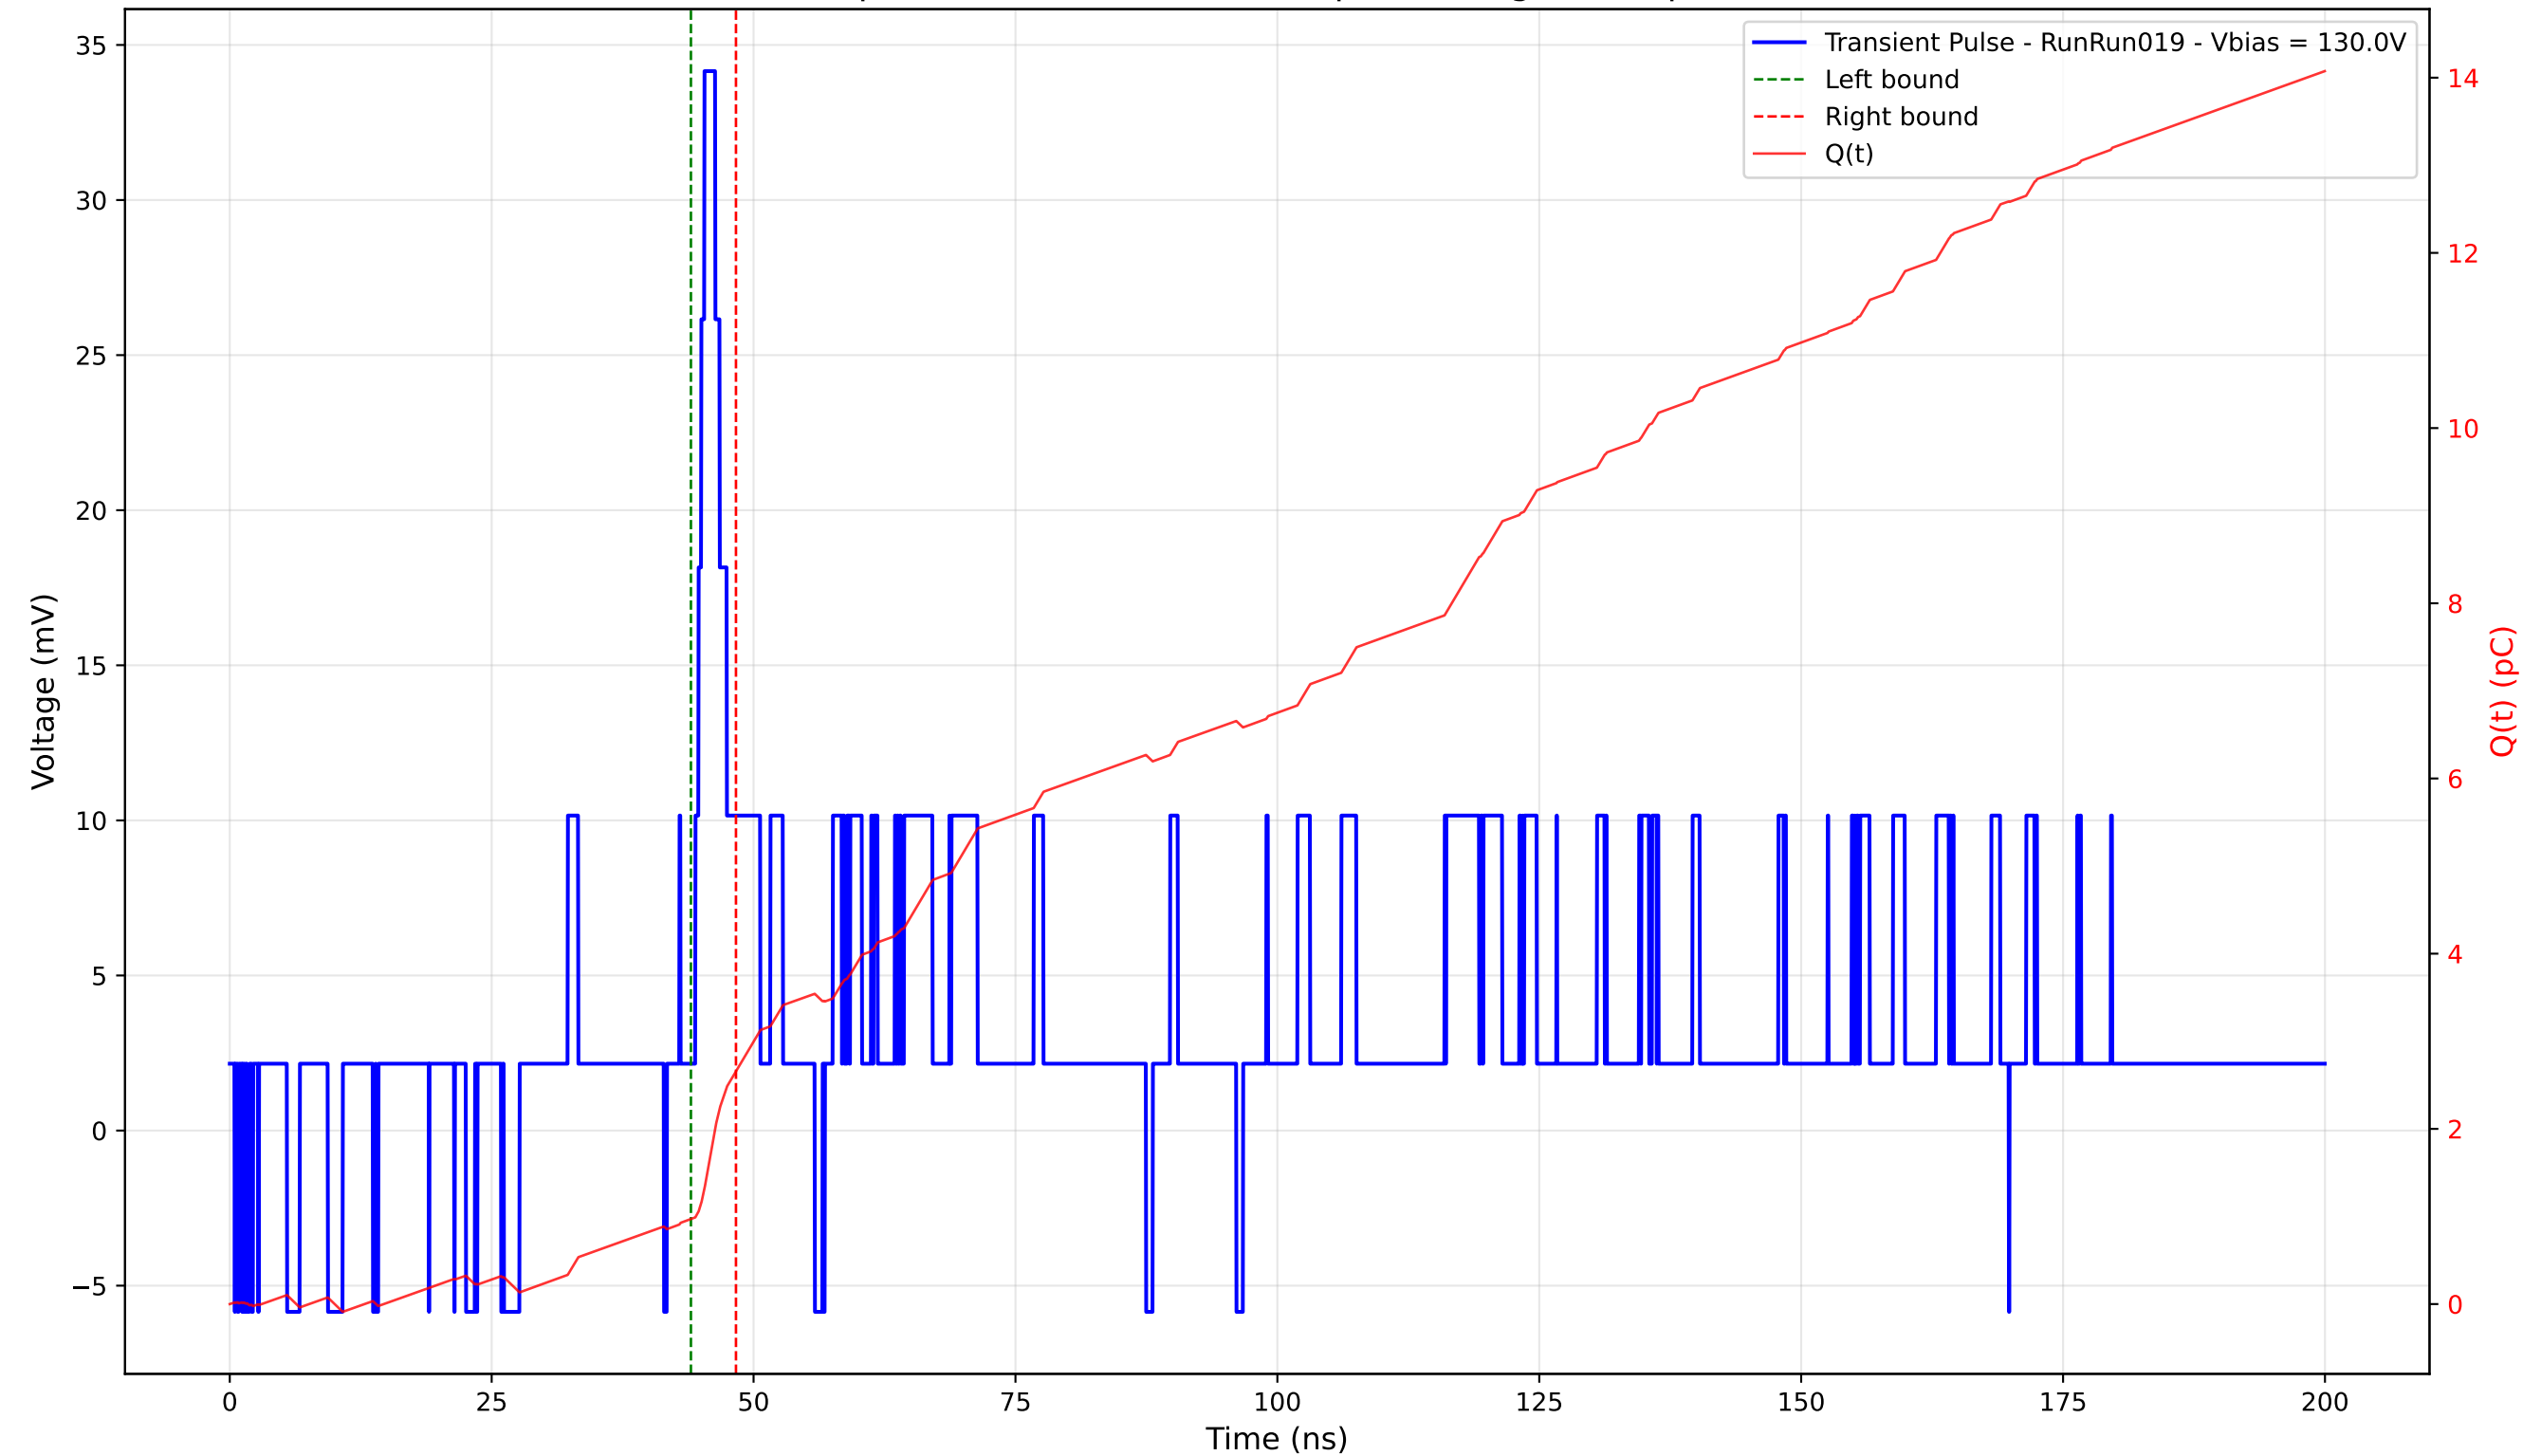


Transient Pulse - Sample: 4003 - Position: 330.0 μm - Charge: 2.43 pC - Rise Time: 1.05 ns

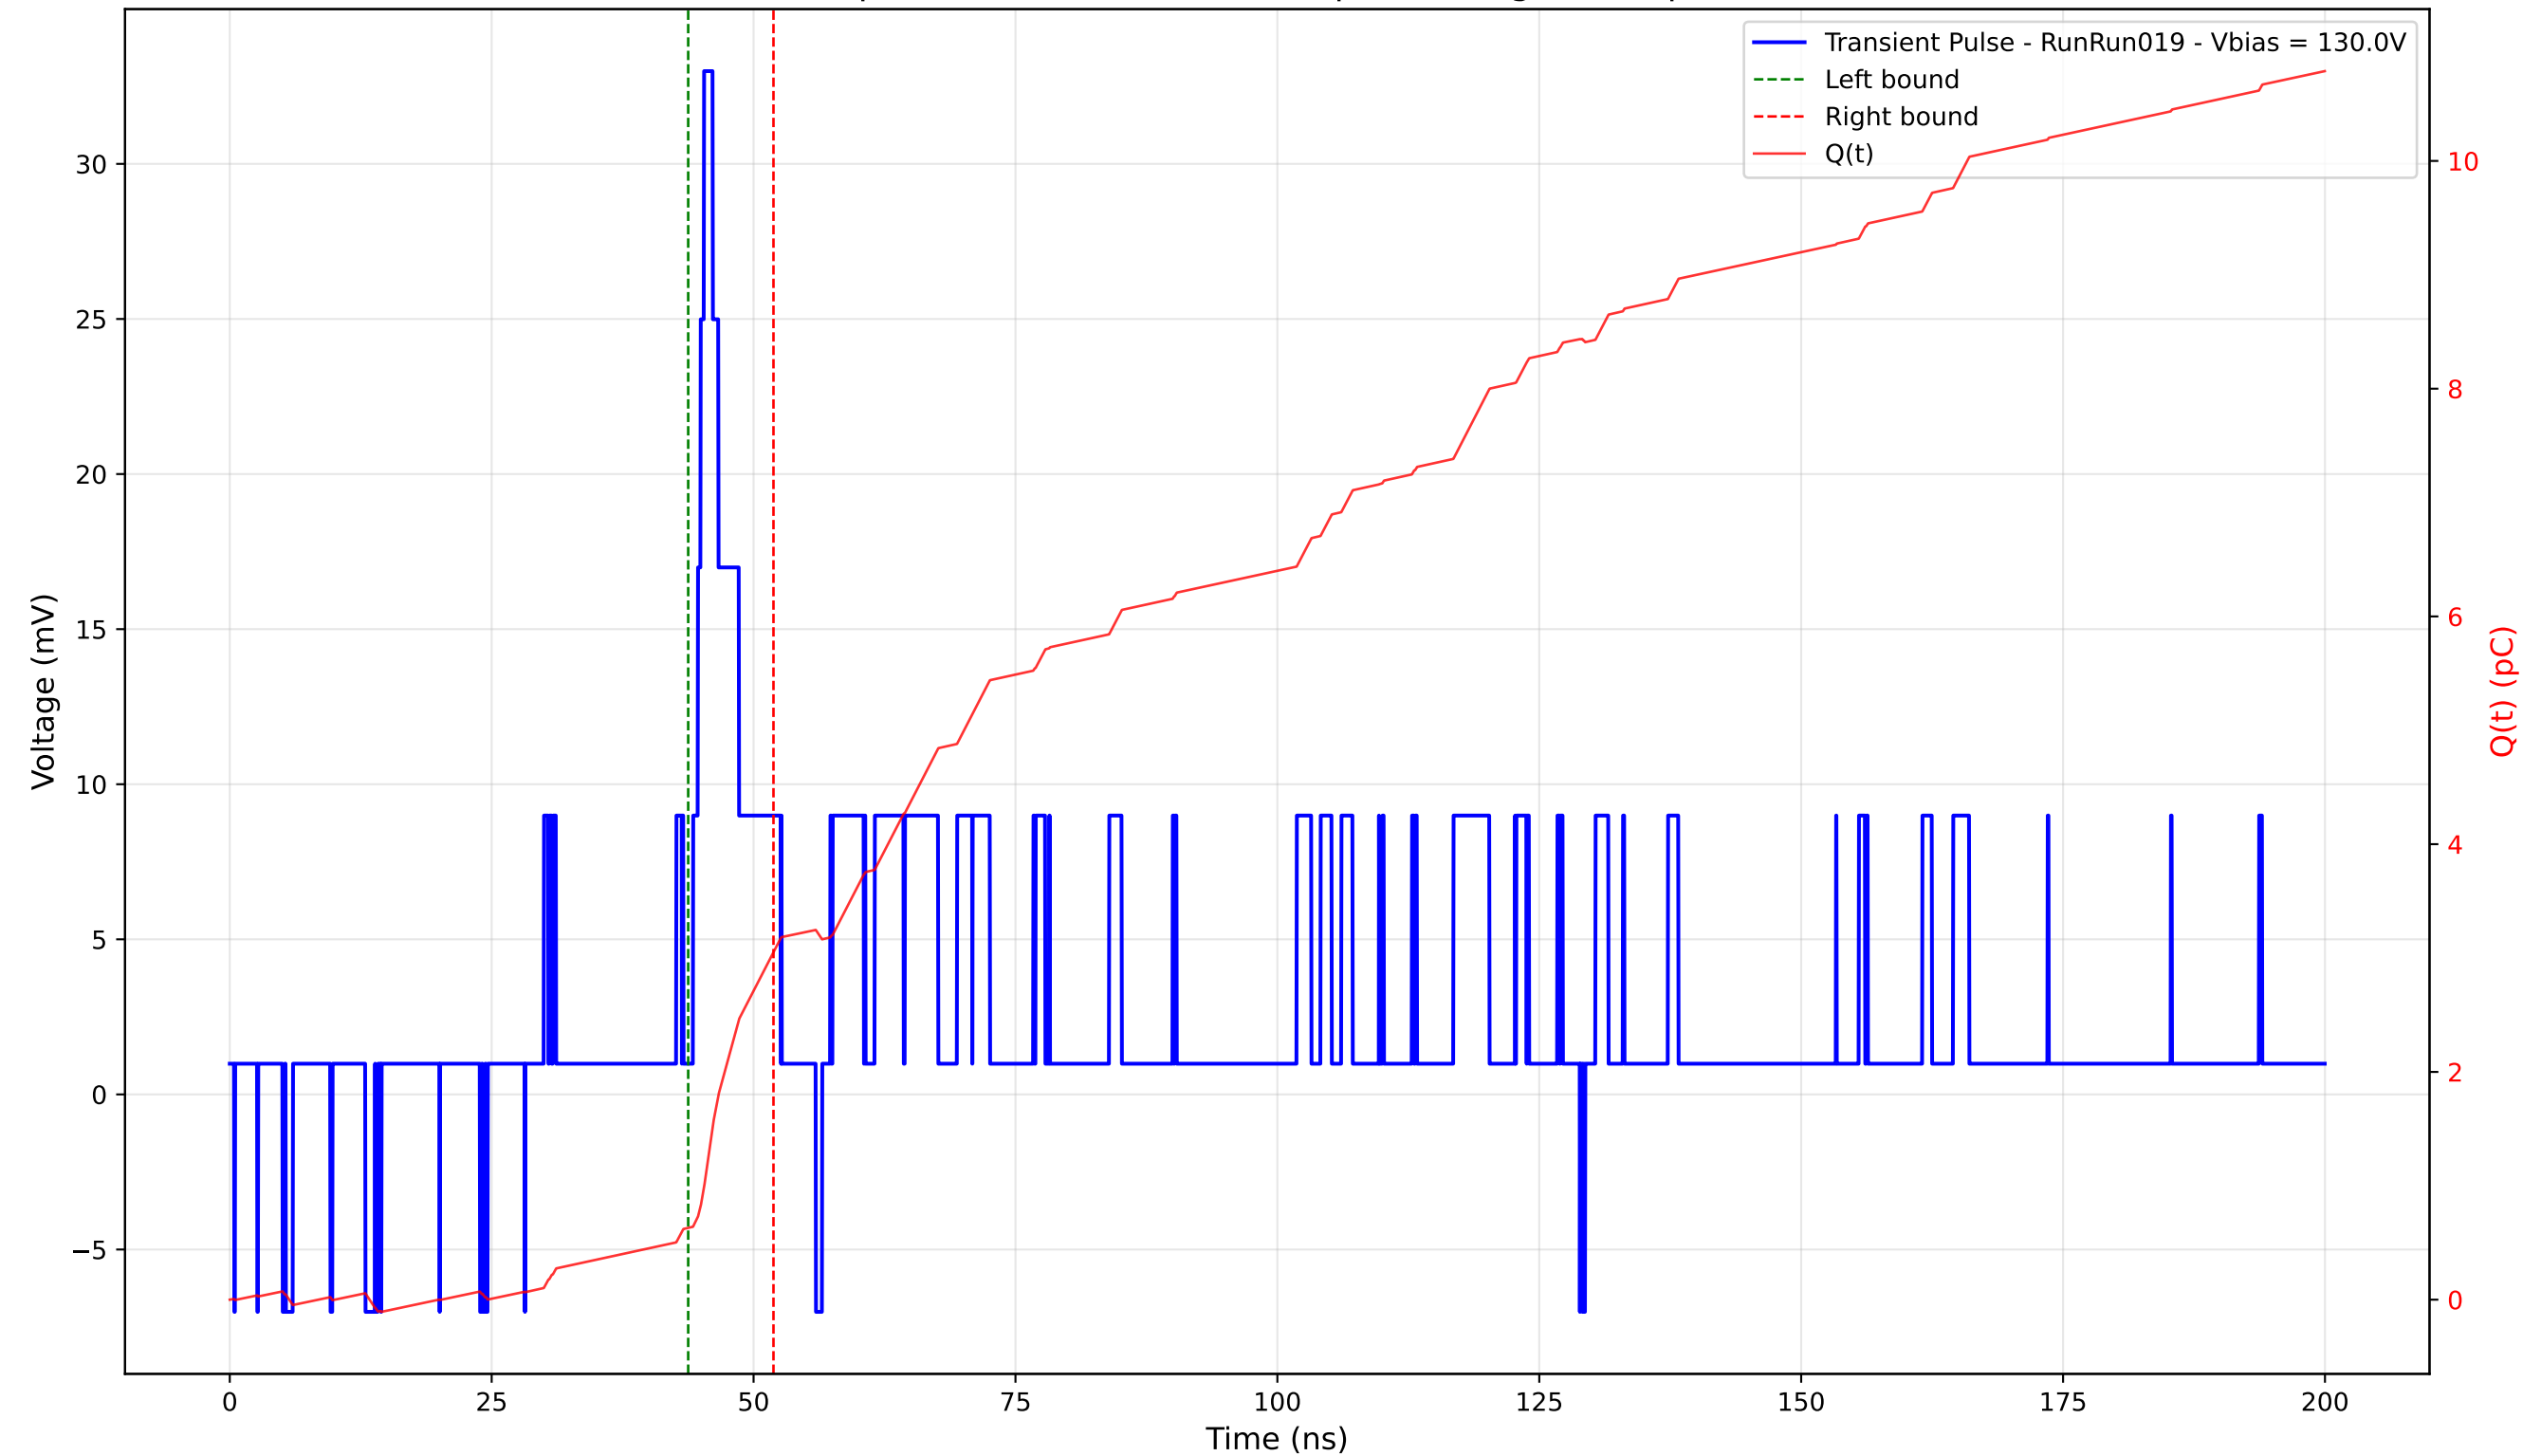


Transient Pulse - Sample: 4003 - Position: 335.0 μm - Charge: 2.04 pC - Rise Time: 0.00 ns (N/A)

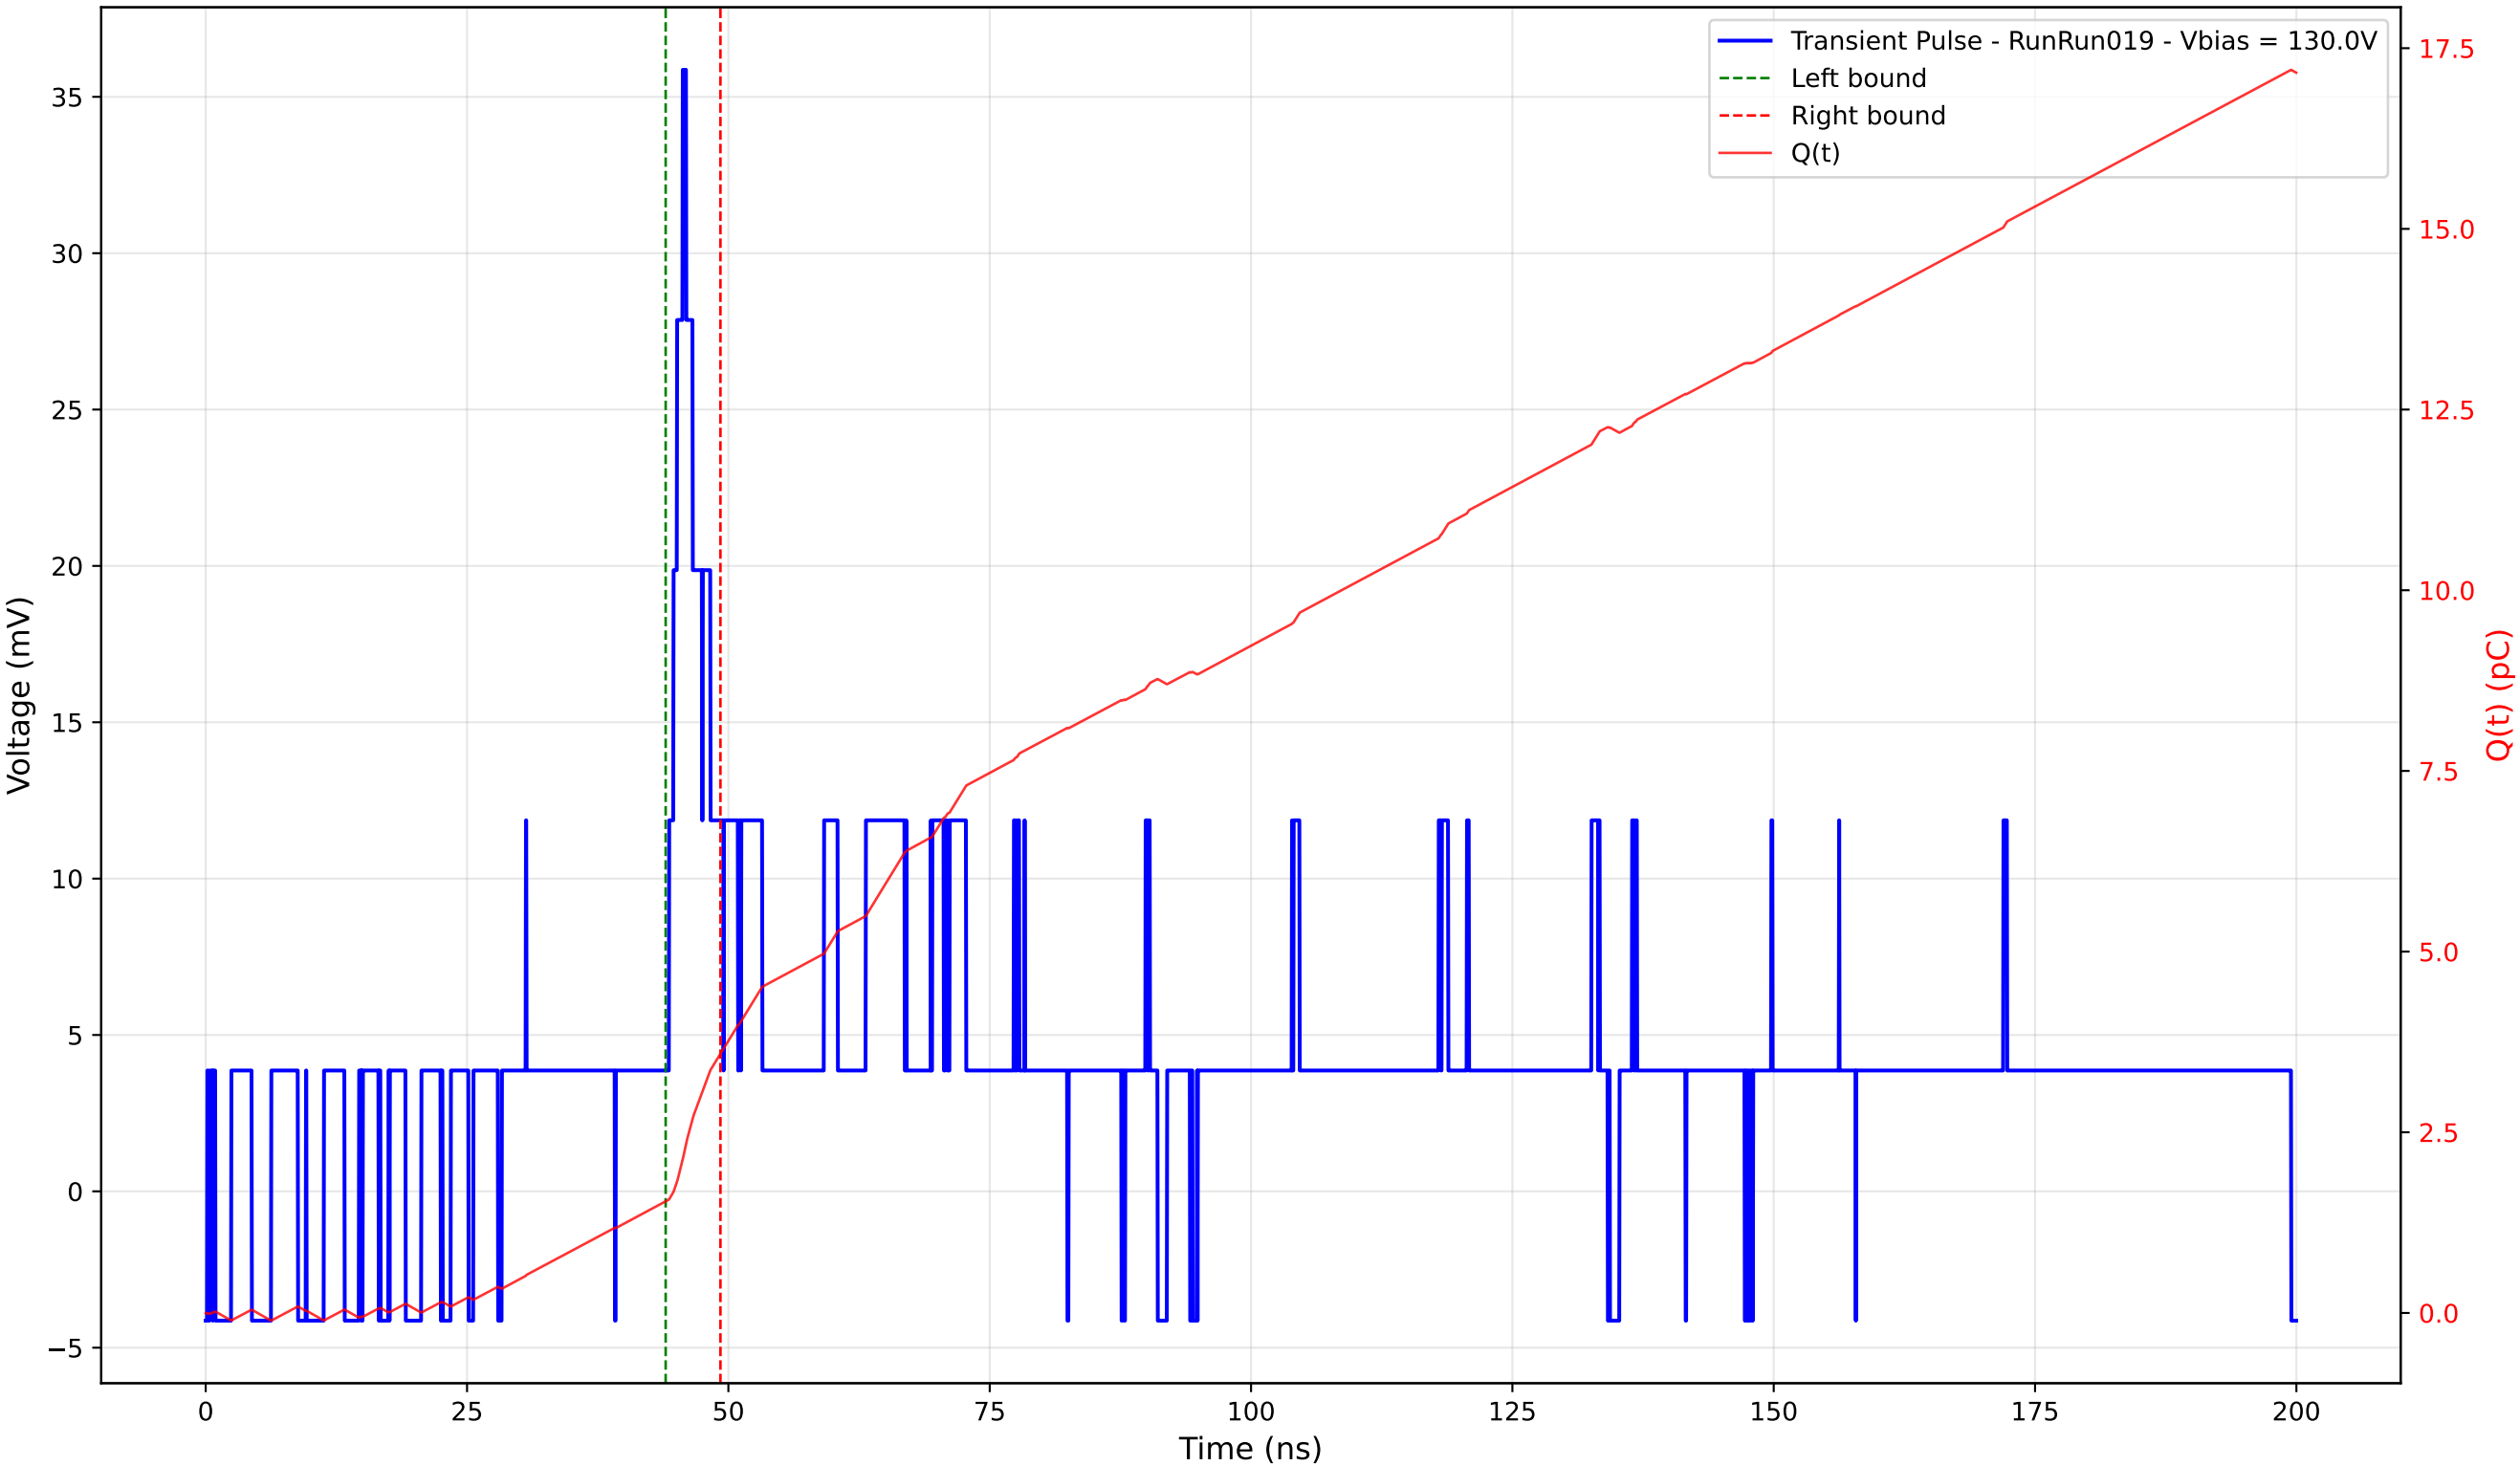


Transient Pulse - Sample: 4003 - Position: 340.0 μm - Charge: 2.63 pC - Rise Time: 2.71 ns

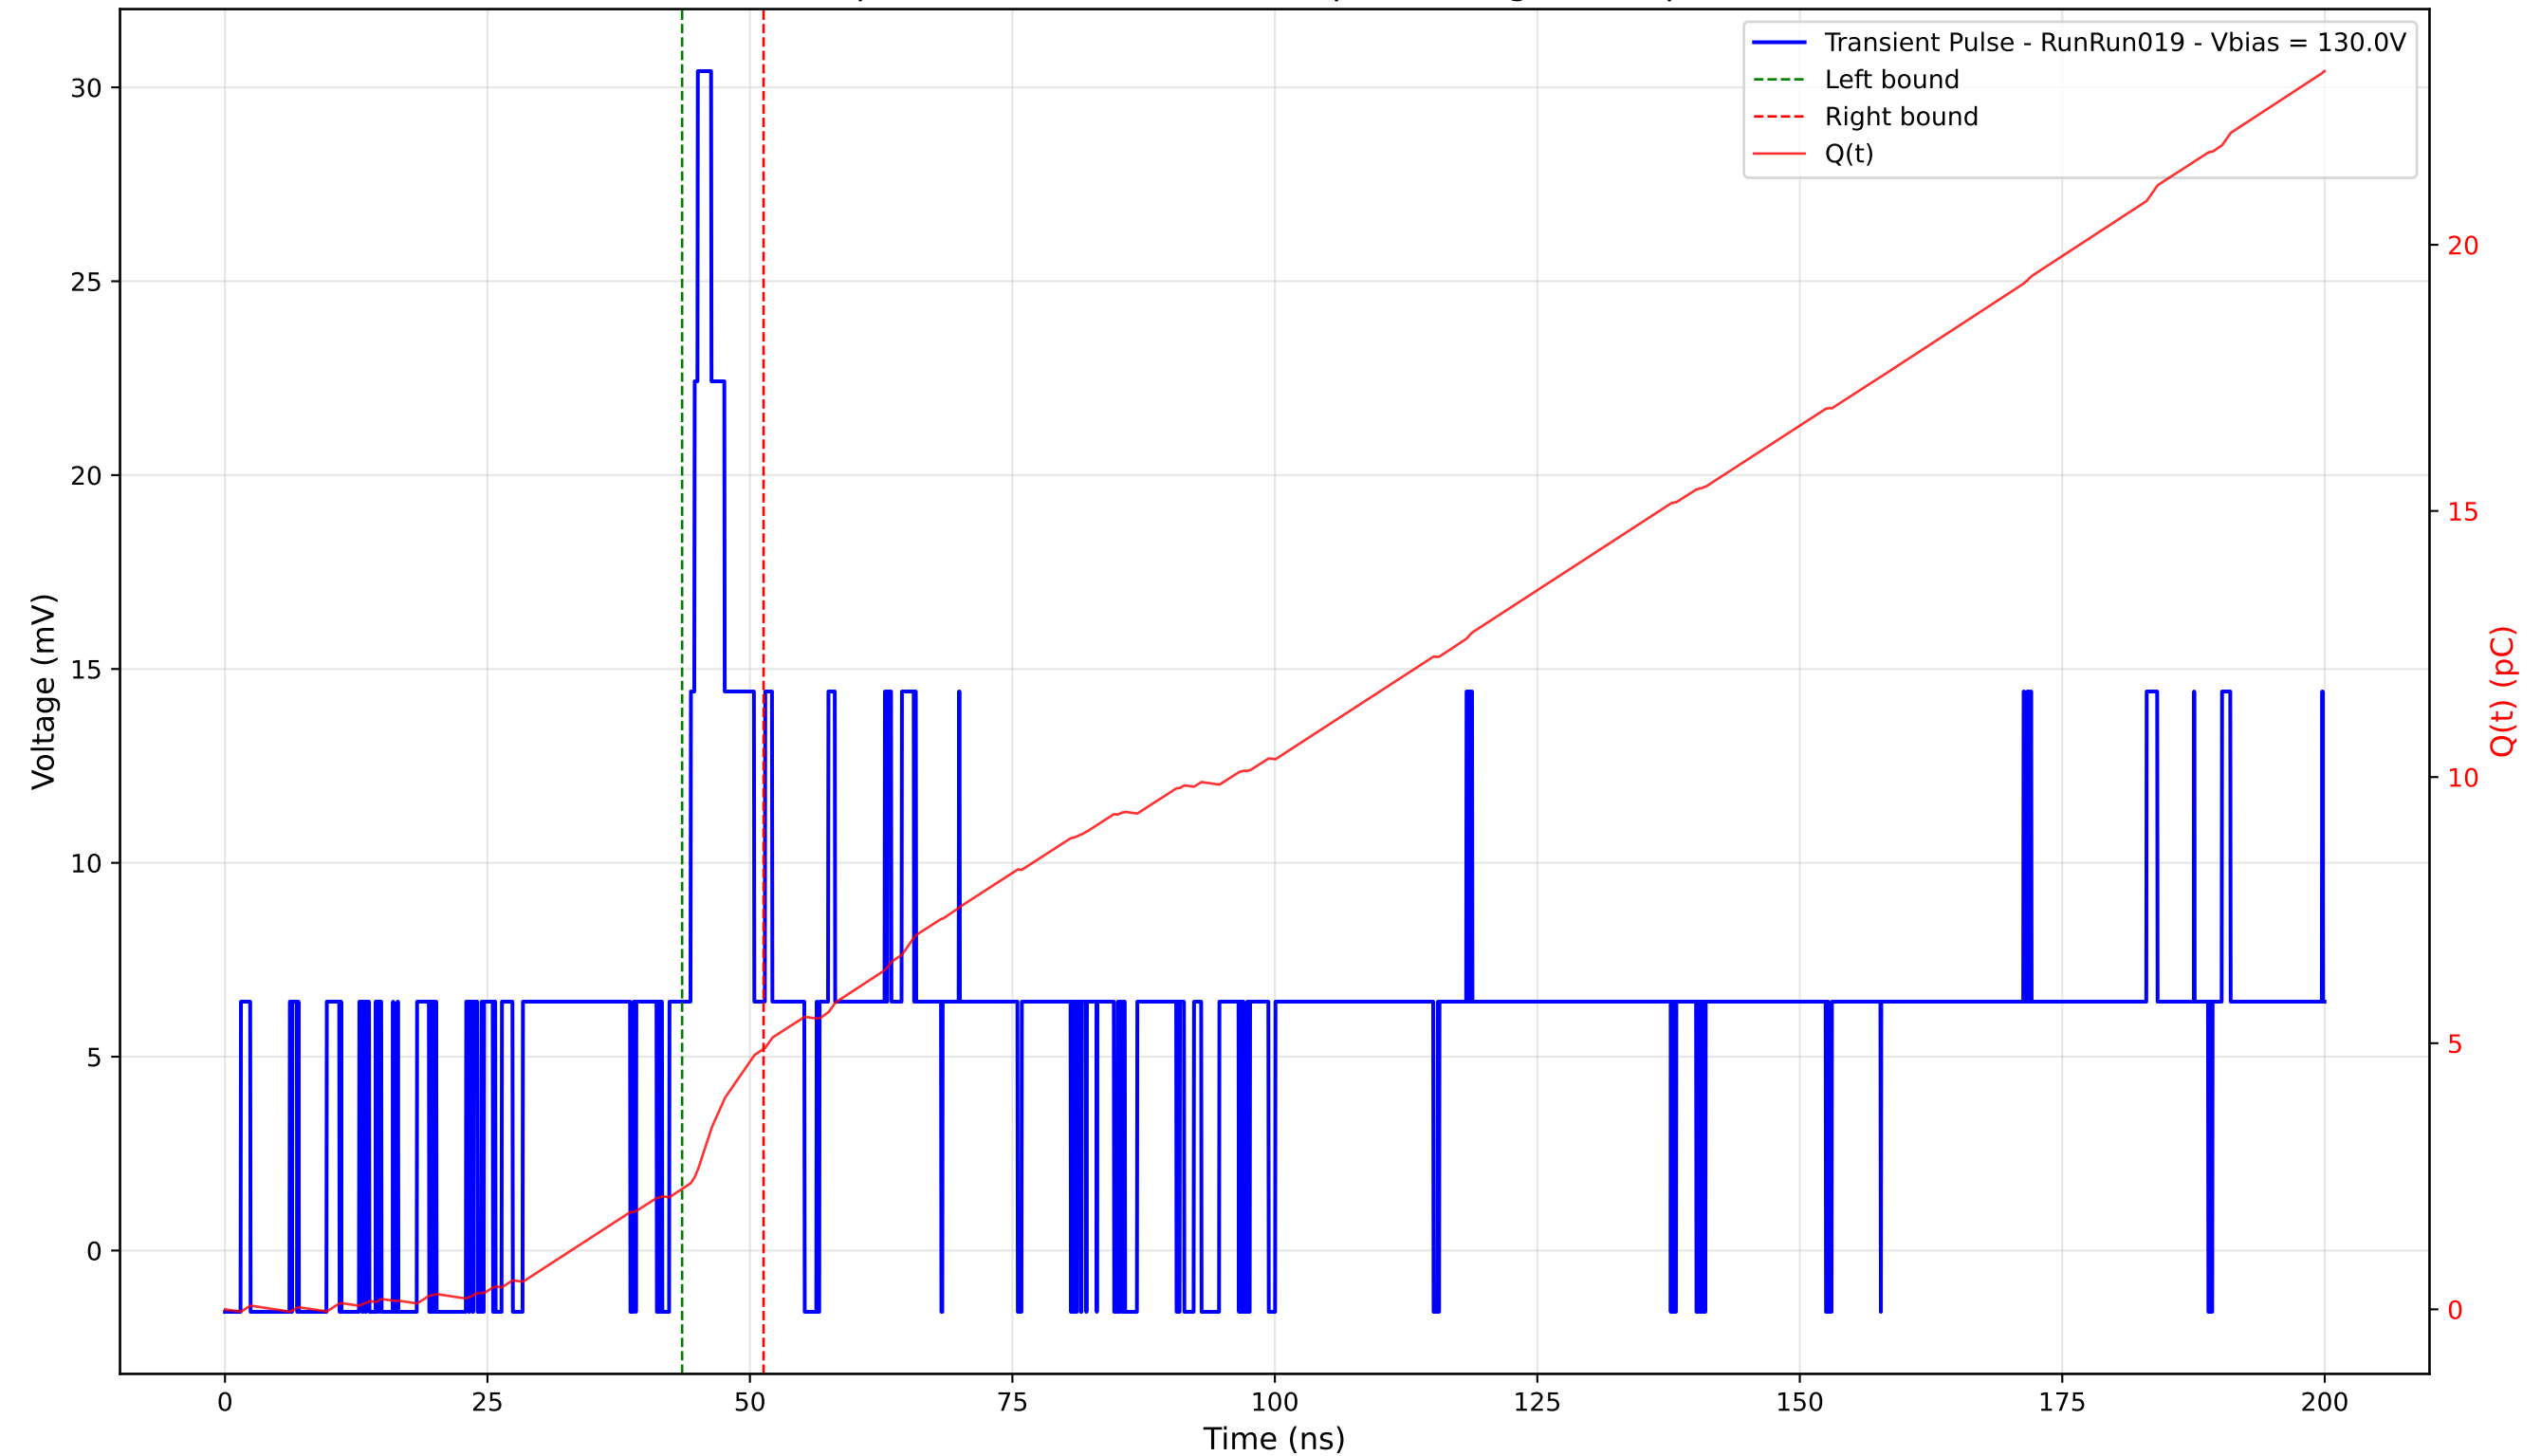


Transient Pulse - Sample: 4003 - Position: 345.0 μm - Charge: 1.30 pC - Rise Time: 1.09 ns

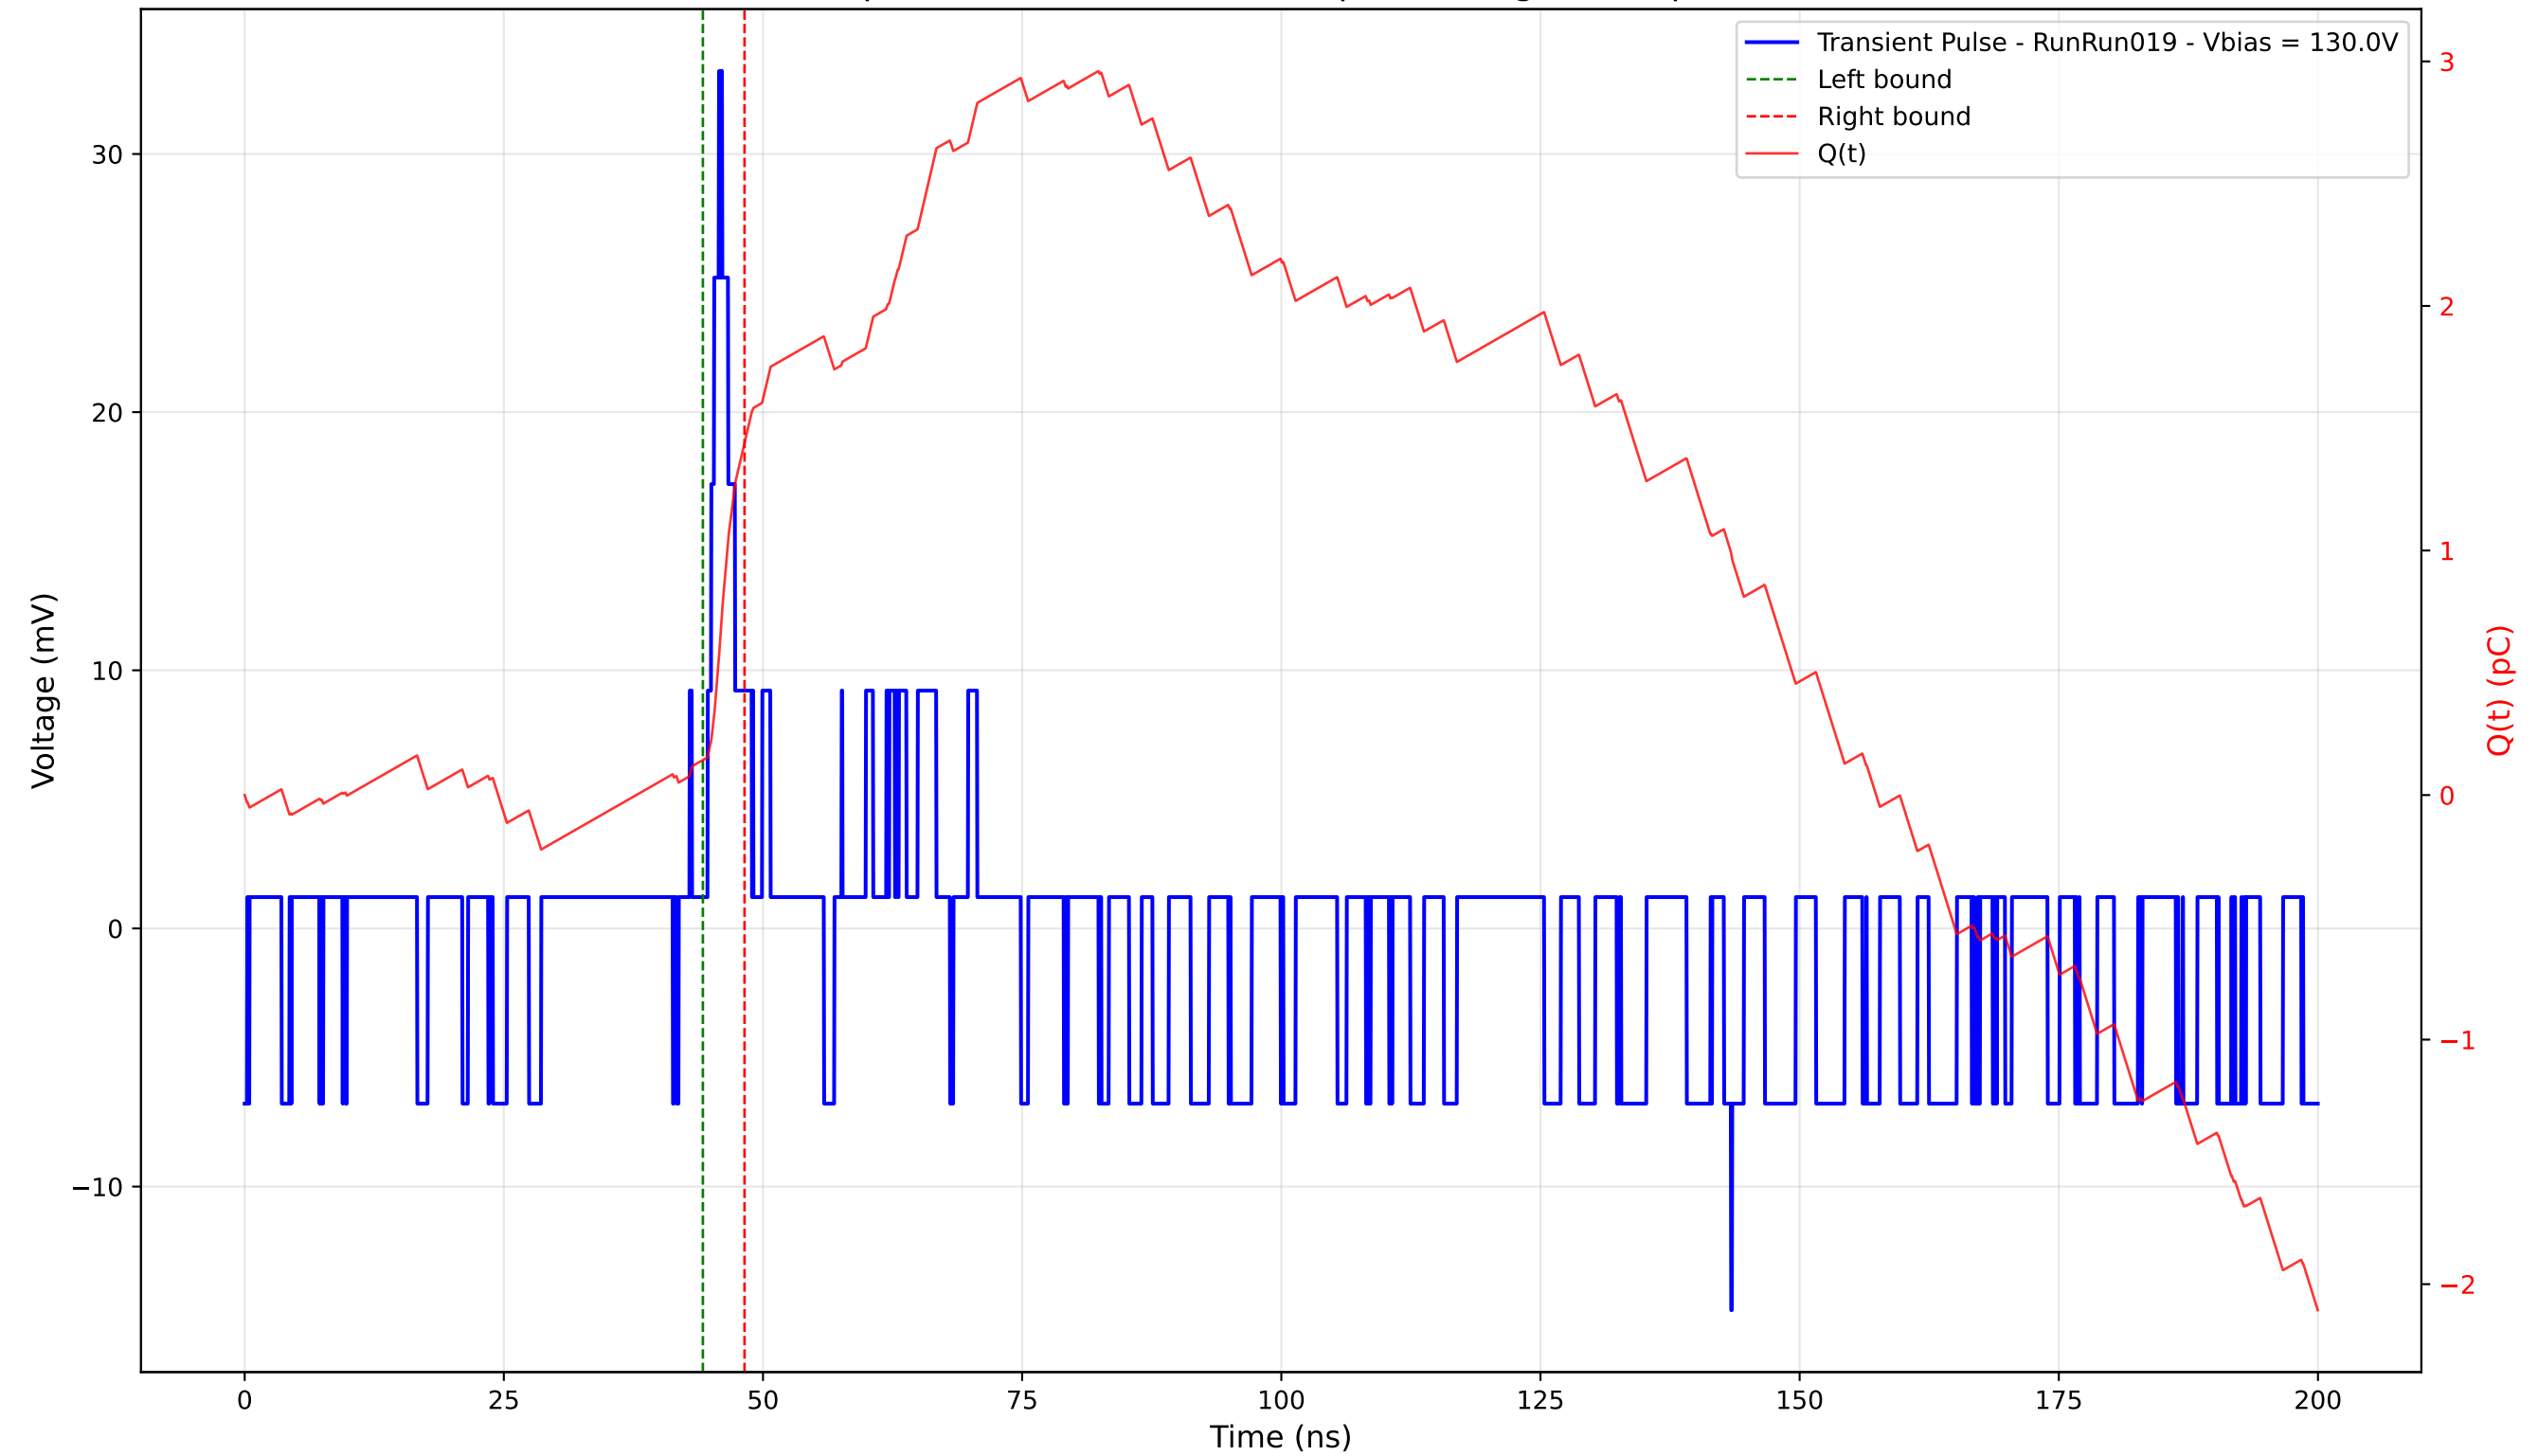

Transient Pulse - Sample: 4003 - Position: 350.0 μm - Charge: 1.80 pC - Rise Time: 1.08 ns

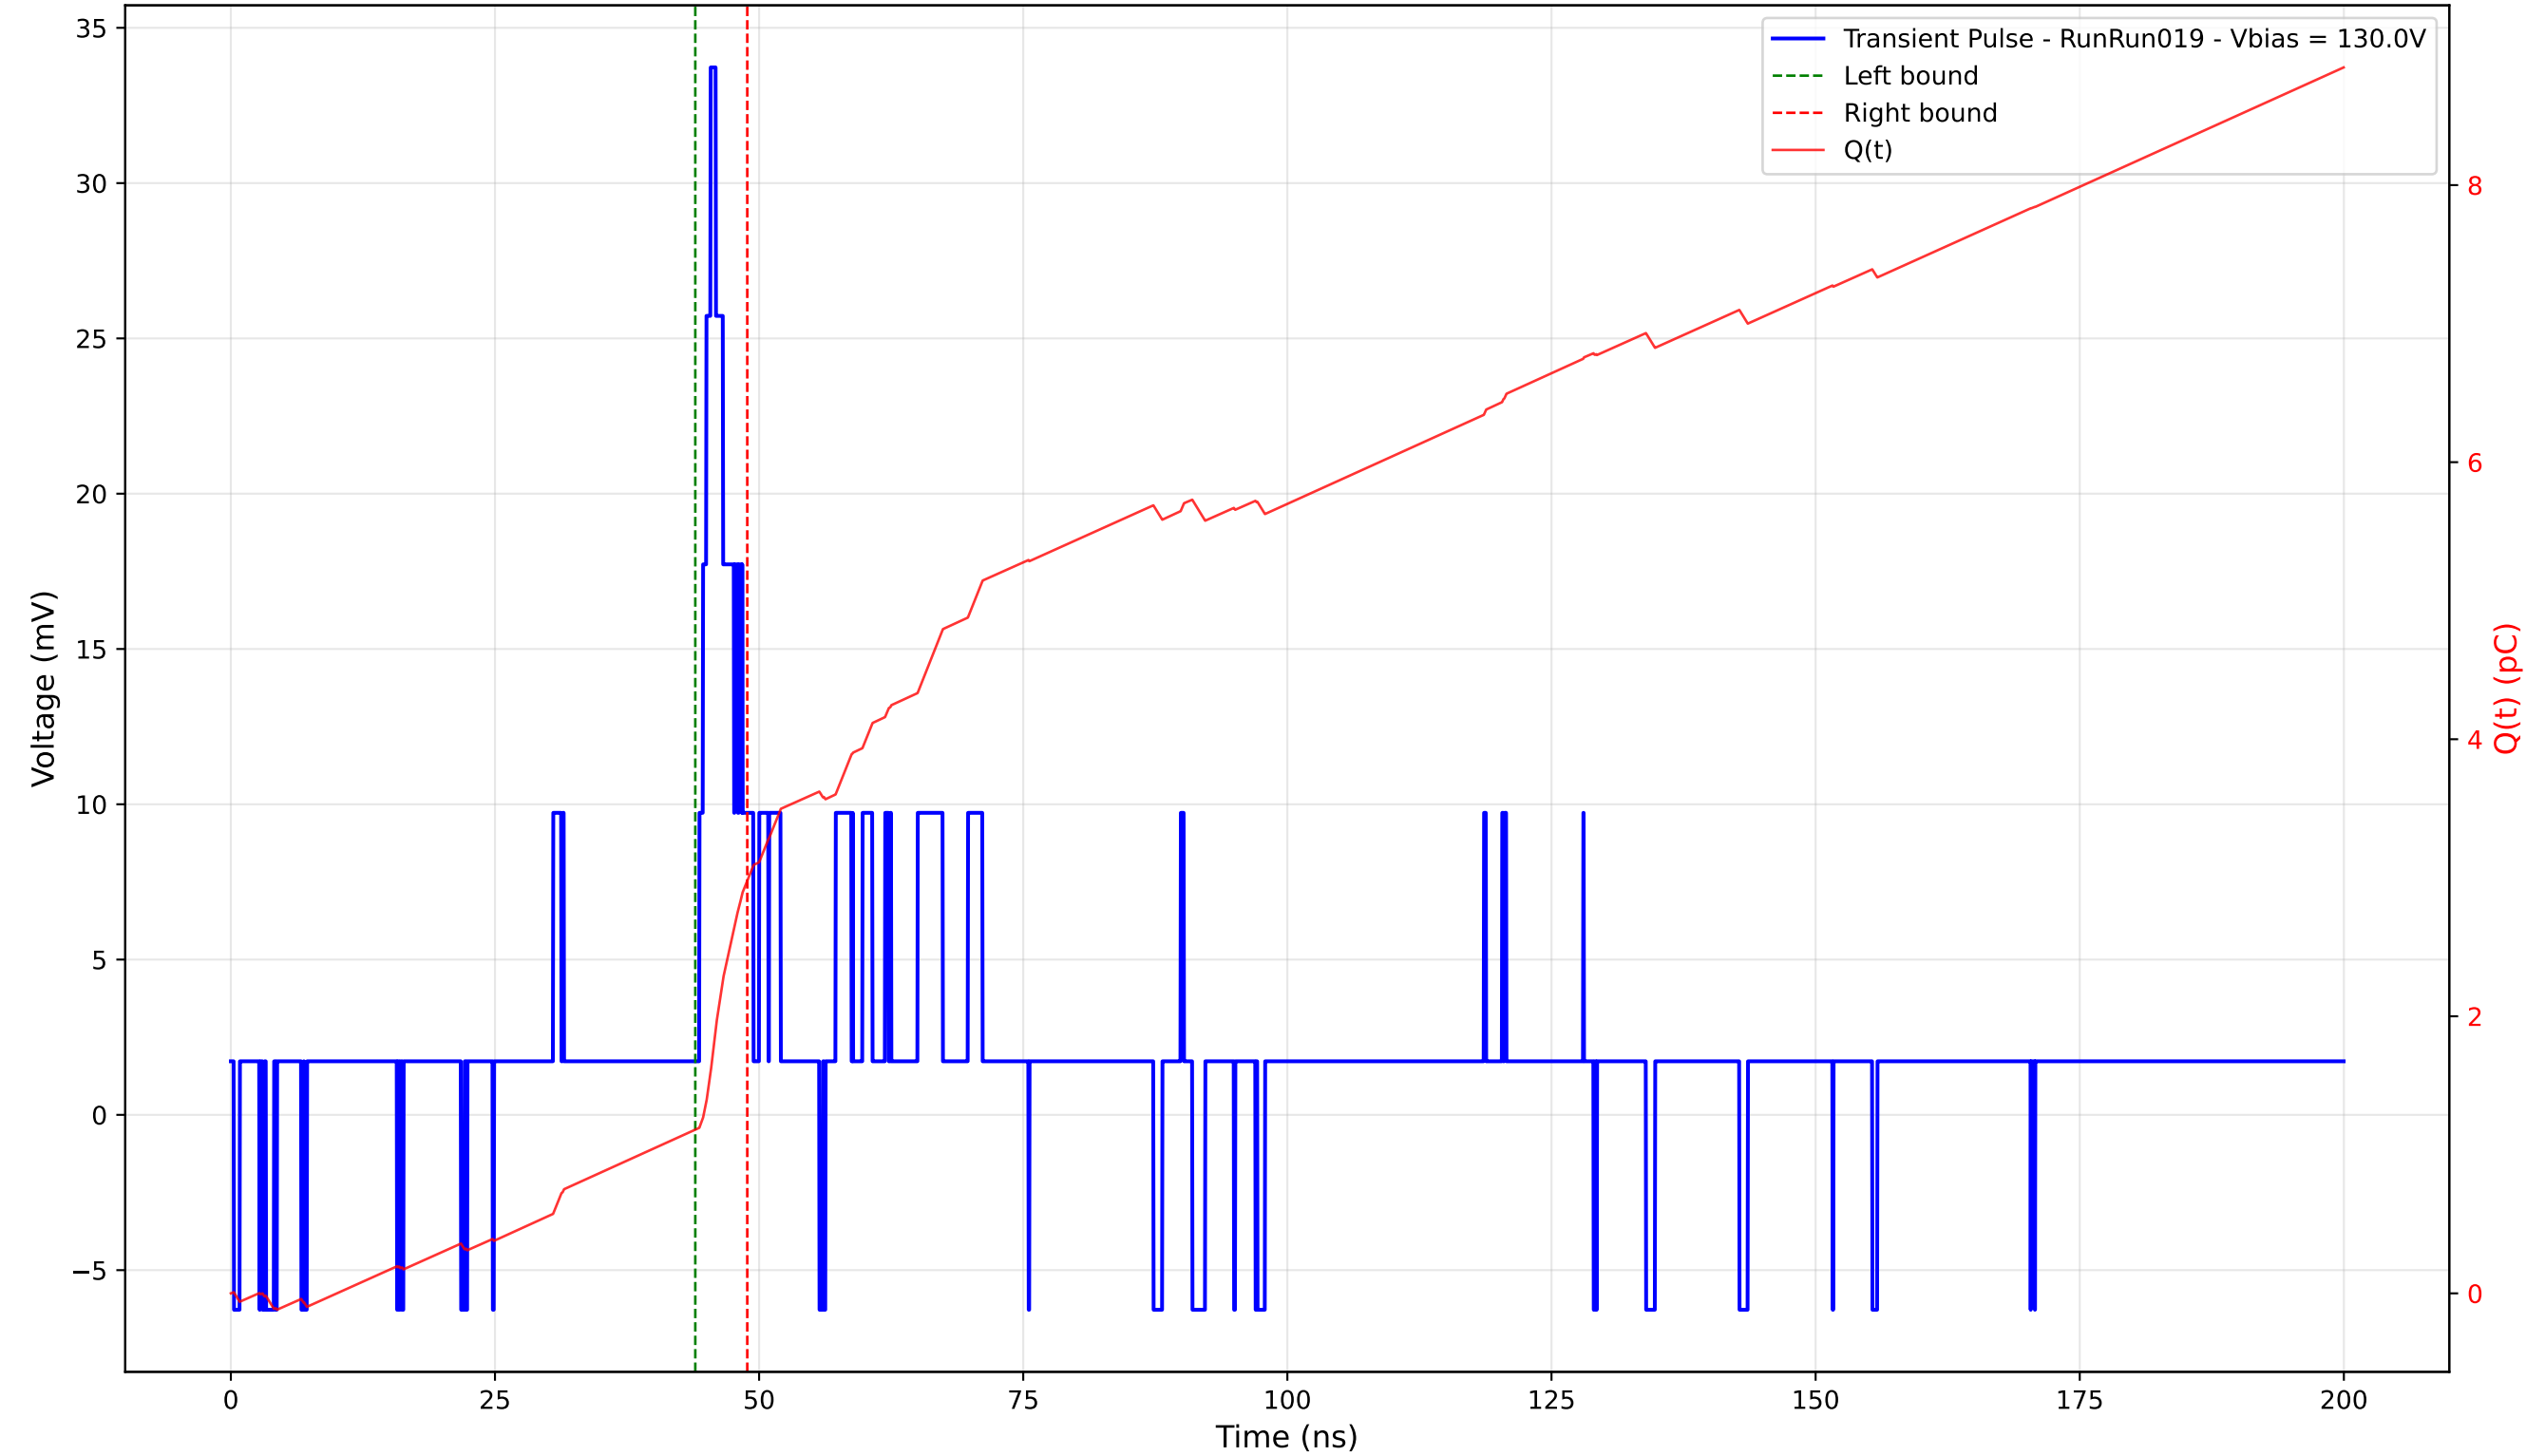


Transient Pulse - Sample: 4003 - Position: 355.0 μm - Charge: 1.49 pC - Rise Time: 1.12 ns

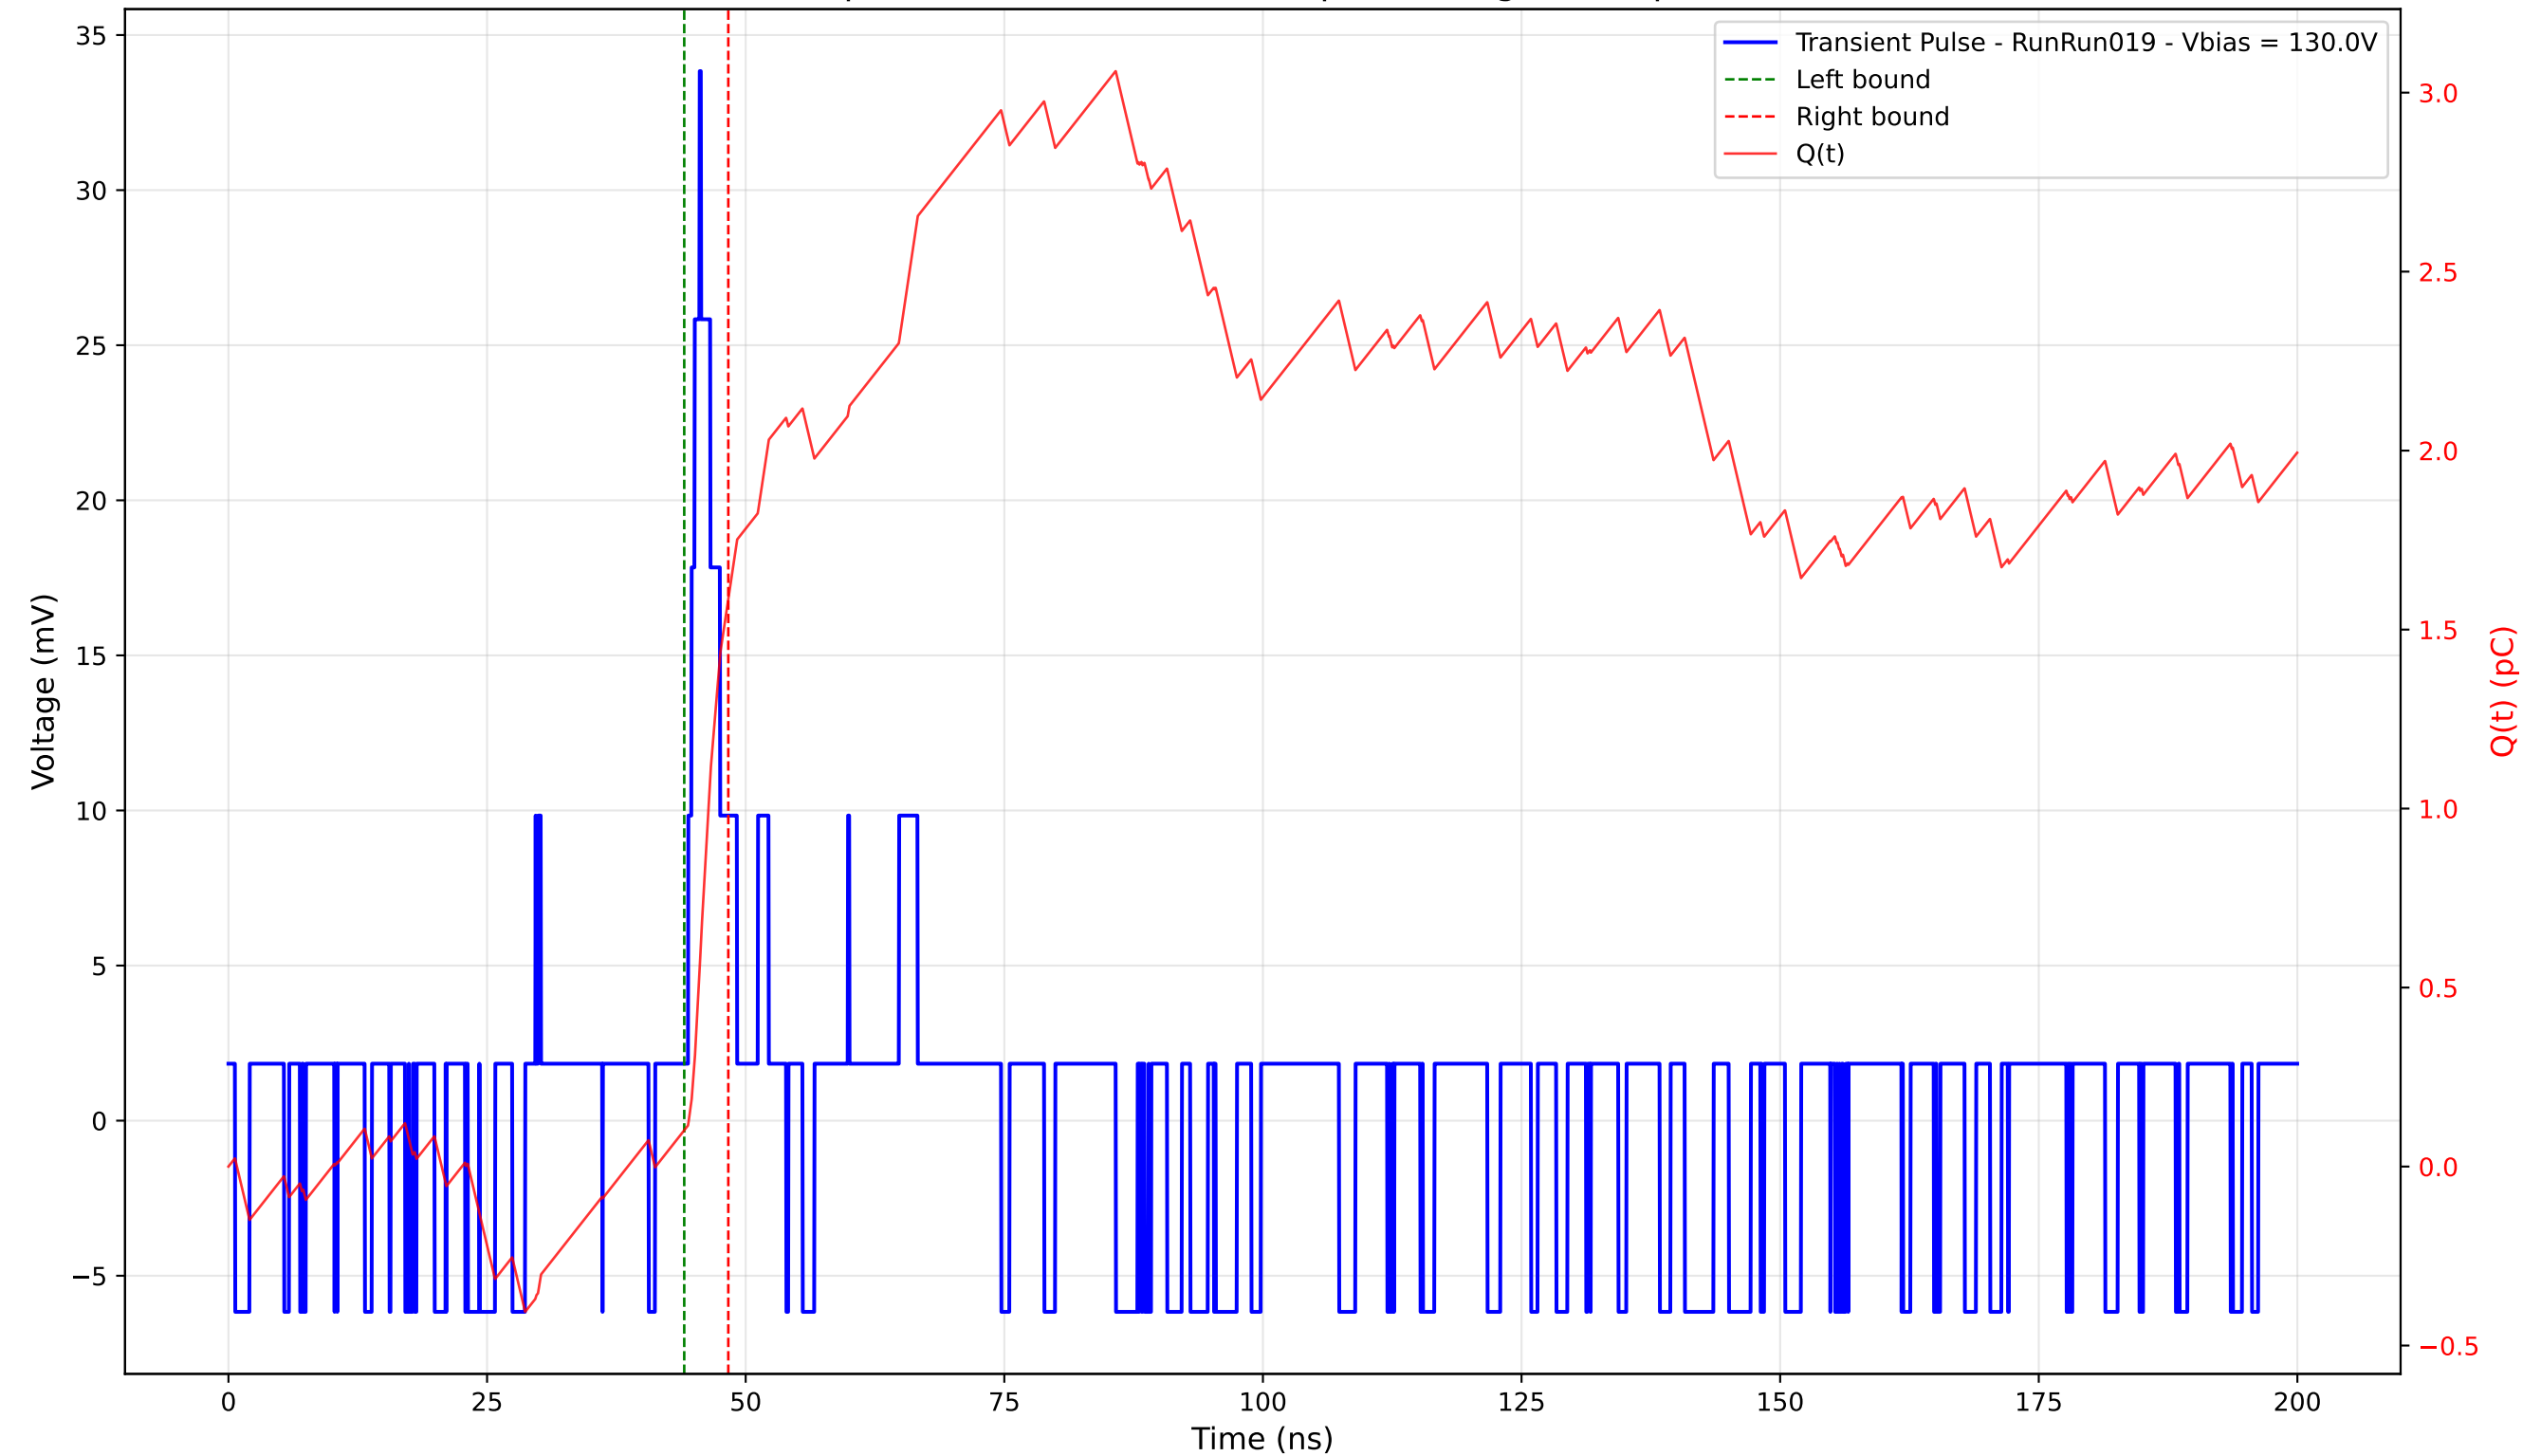


Transient Pulse - Sample: 4003 - Position: 360.0 μm - Charge: 1.91 pC - Rise Time: 0.86 ns




Transient Pulse - Sample: 4003 - Position: 365.0 μm - Charge: 2.10 pC - Rise Time: 0.85 ns

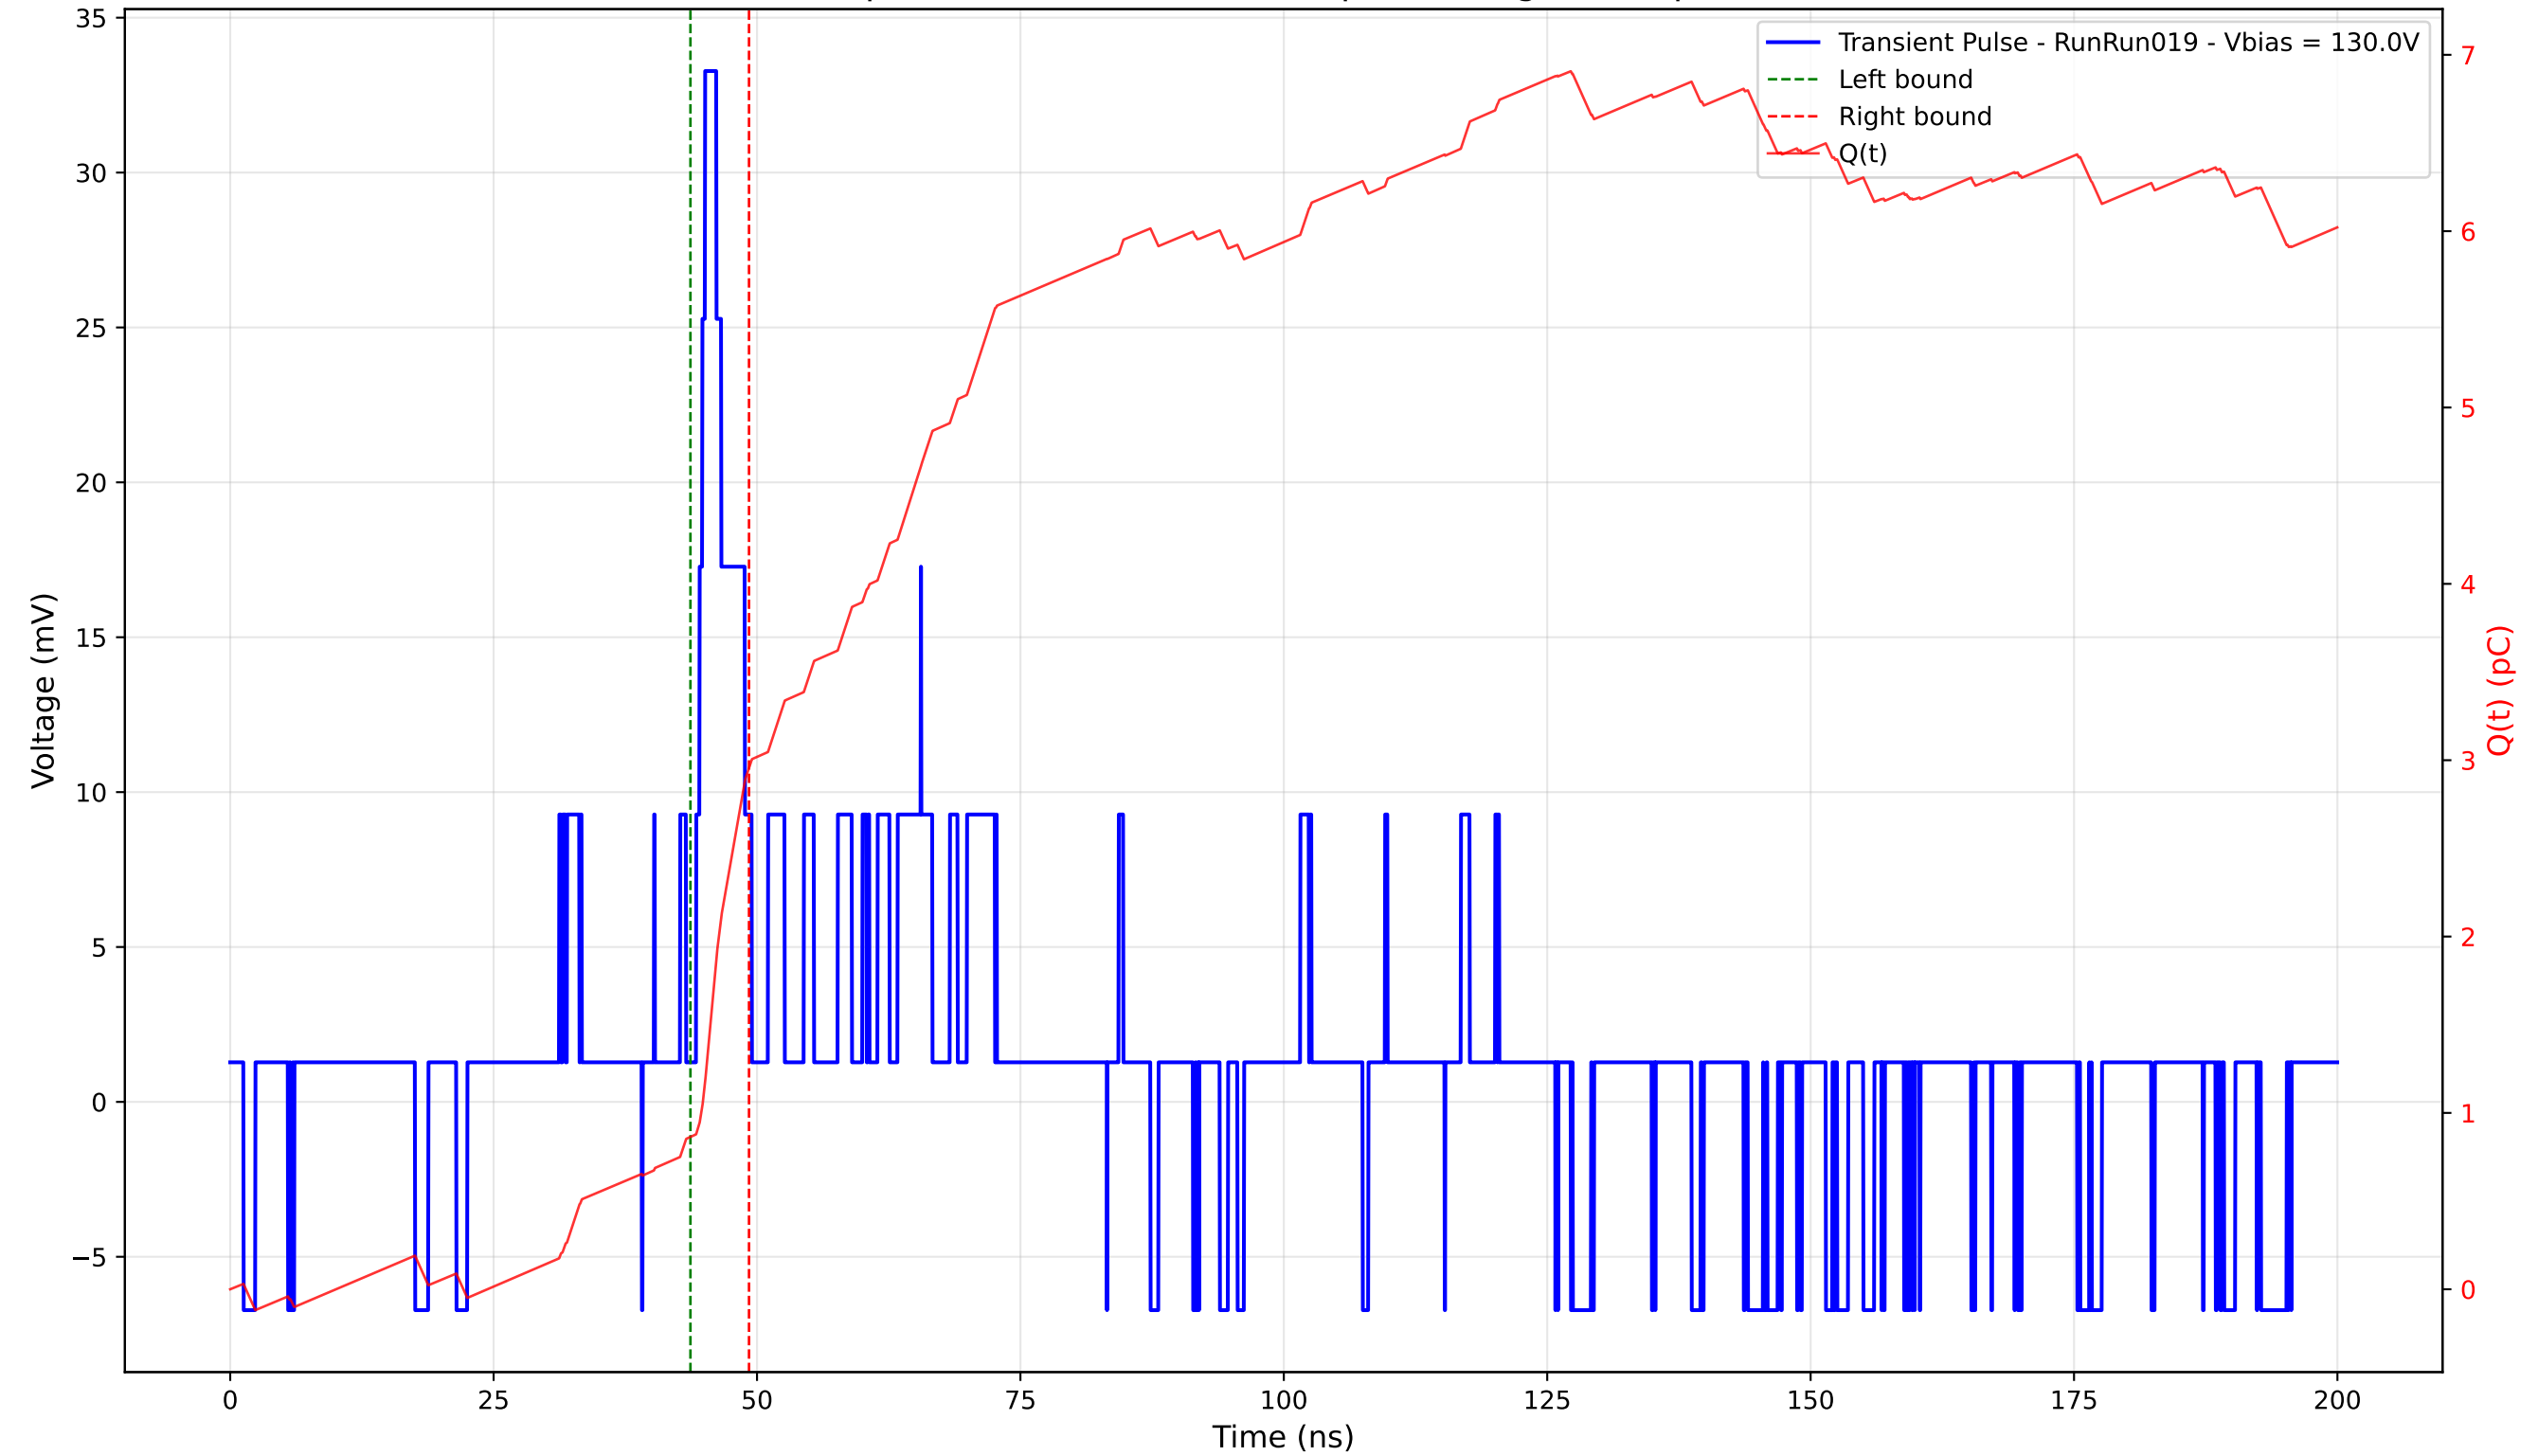


Transient Pulse - Sample: 4003 - Position: 370.0 μm - Charge: 1.81 pC - Rise Time: 0.86 ns

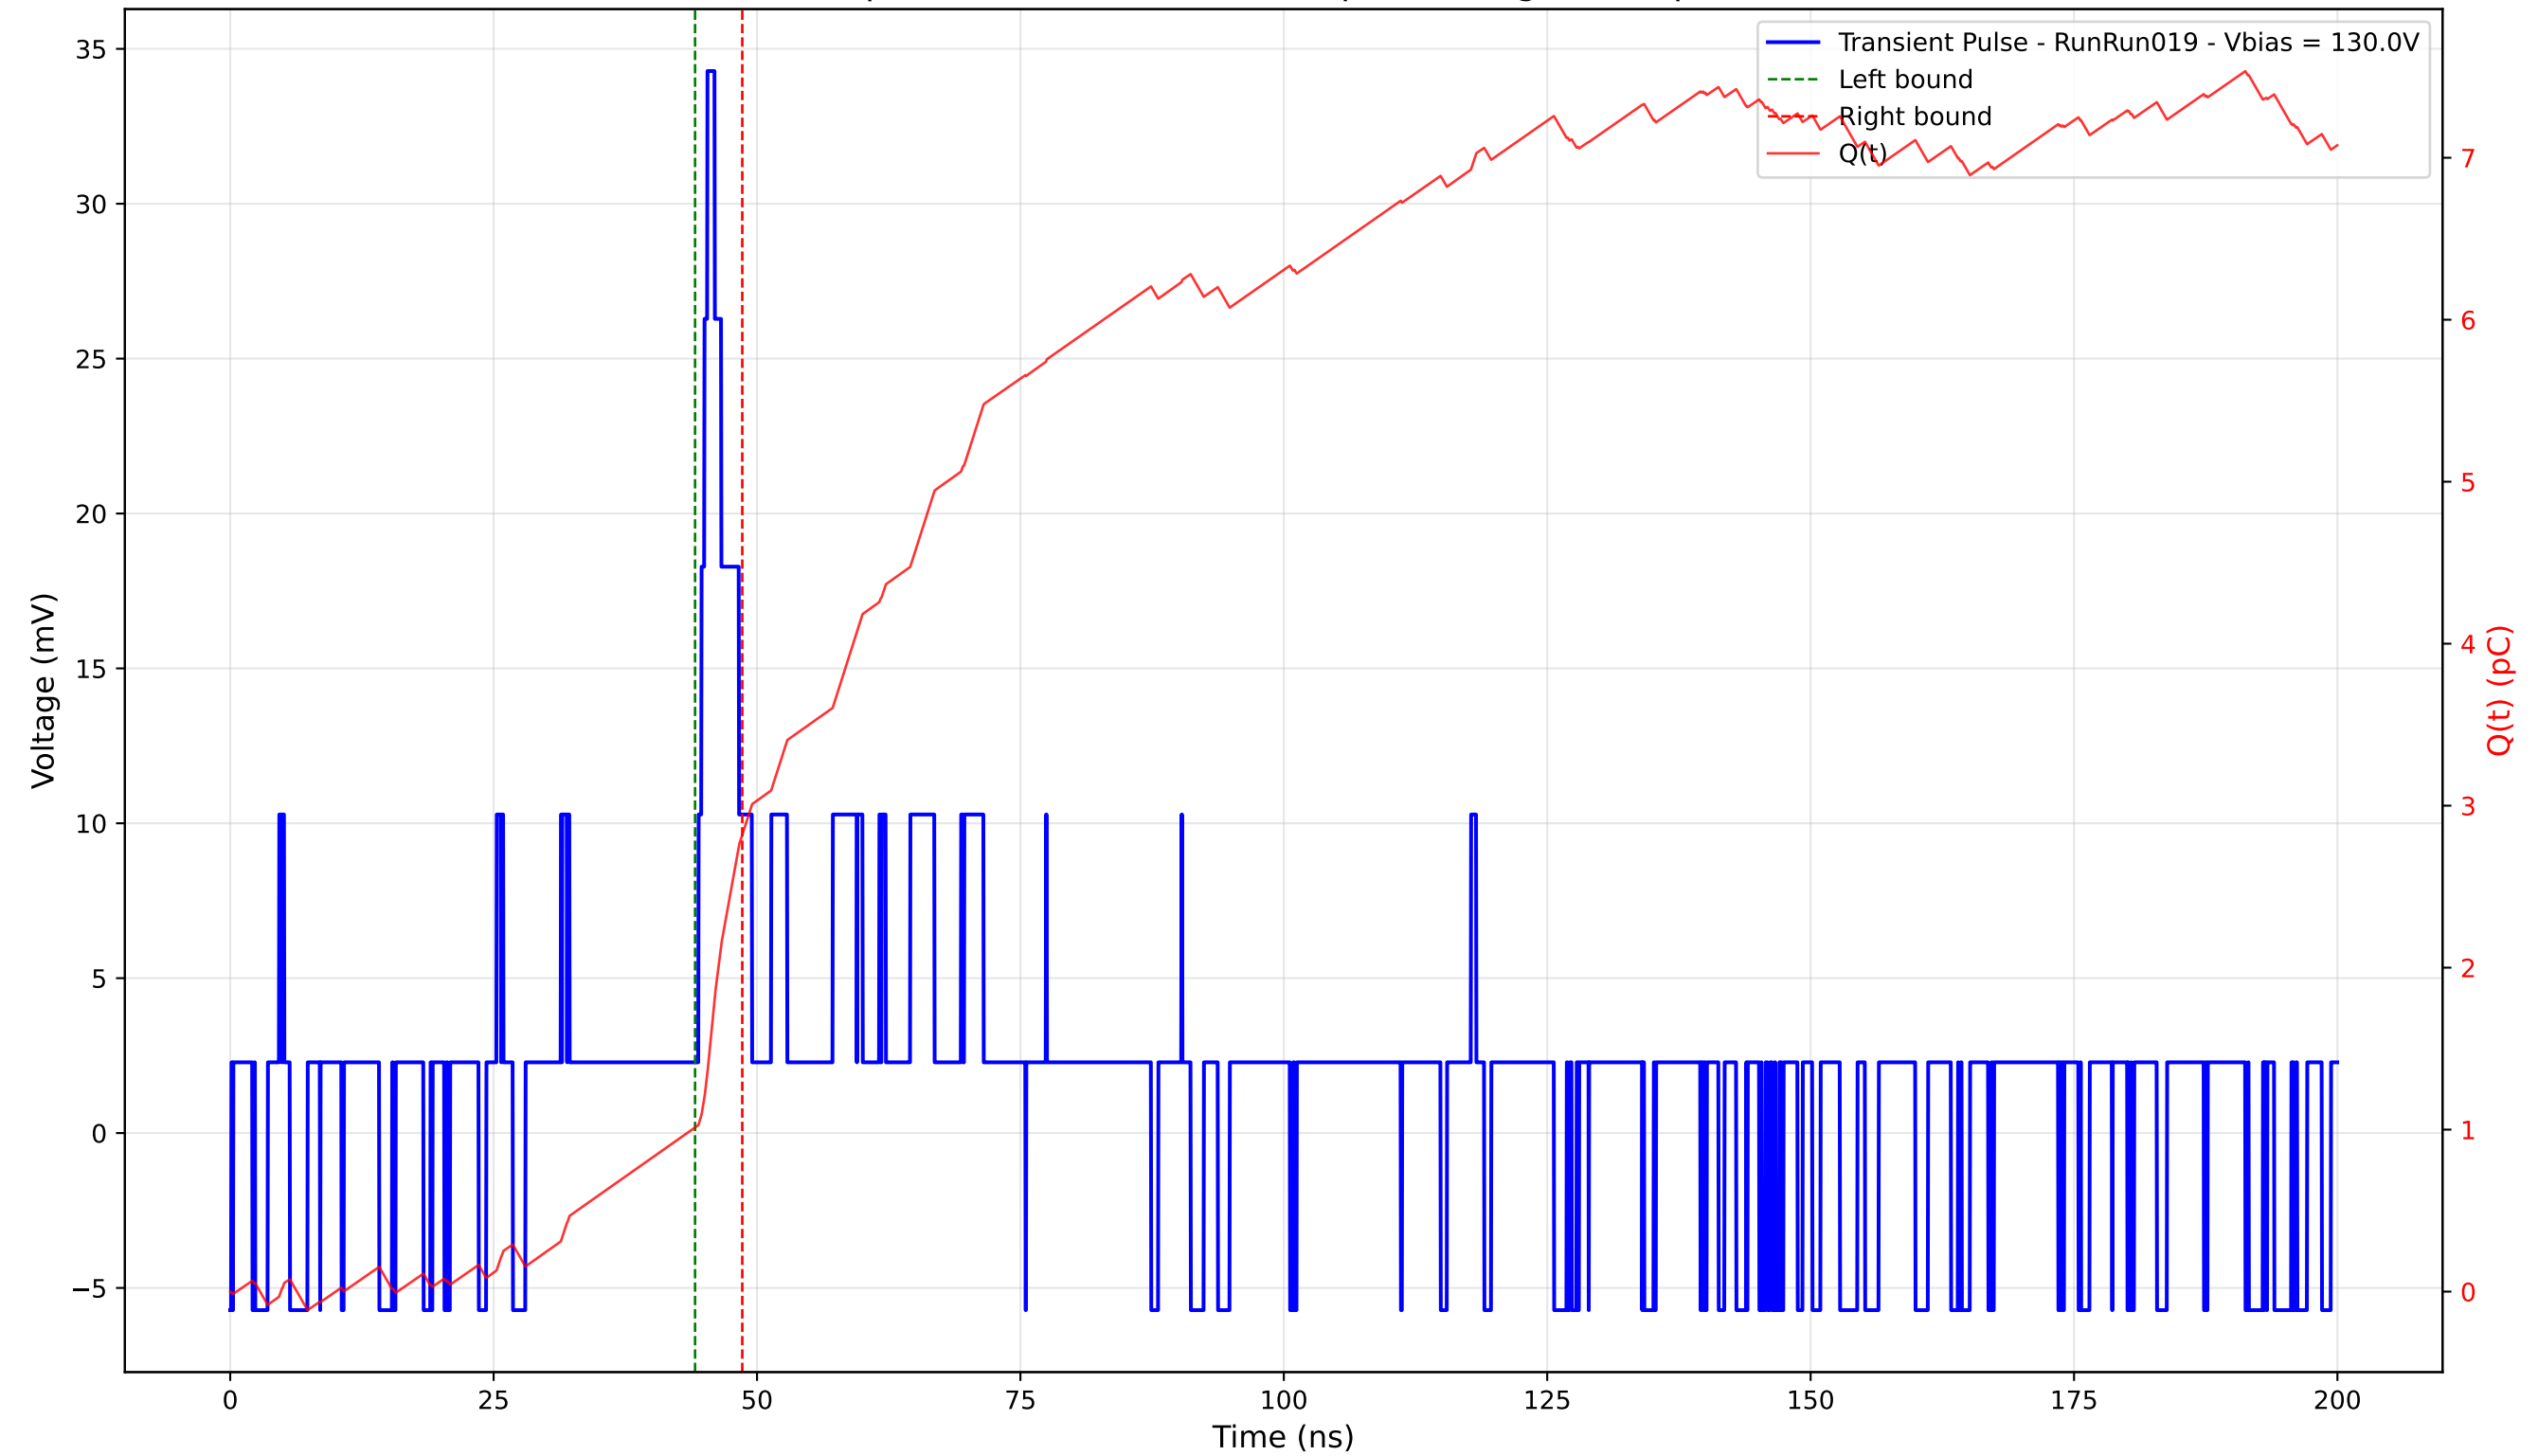


Transient Pulse - Sample: 4003 - Position: 375.0 μm - Charge: 2.04 pC - Rise Time: 1.31 ns

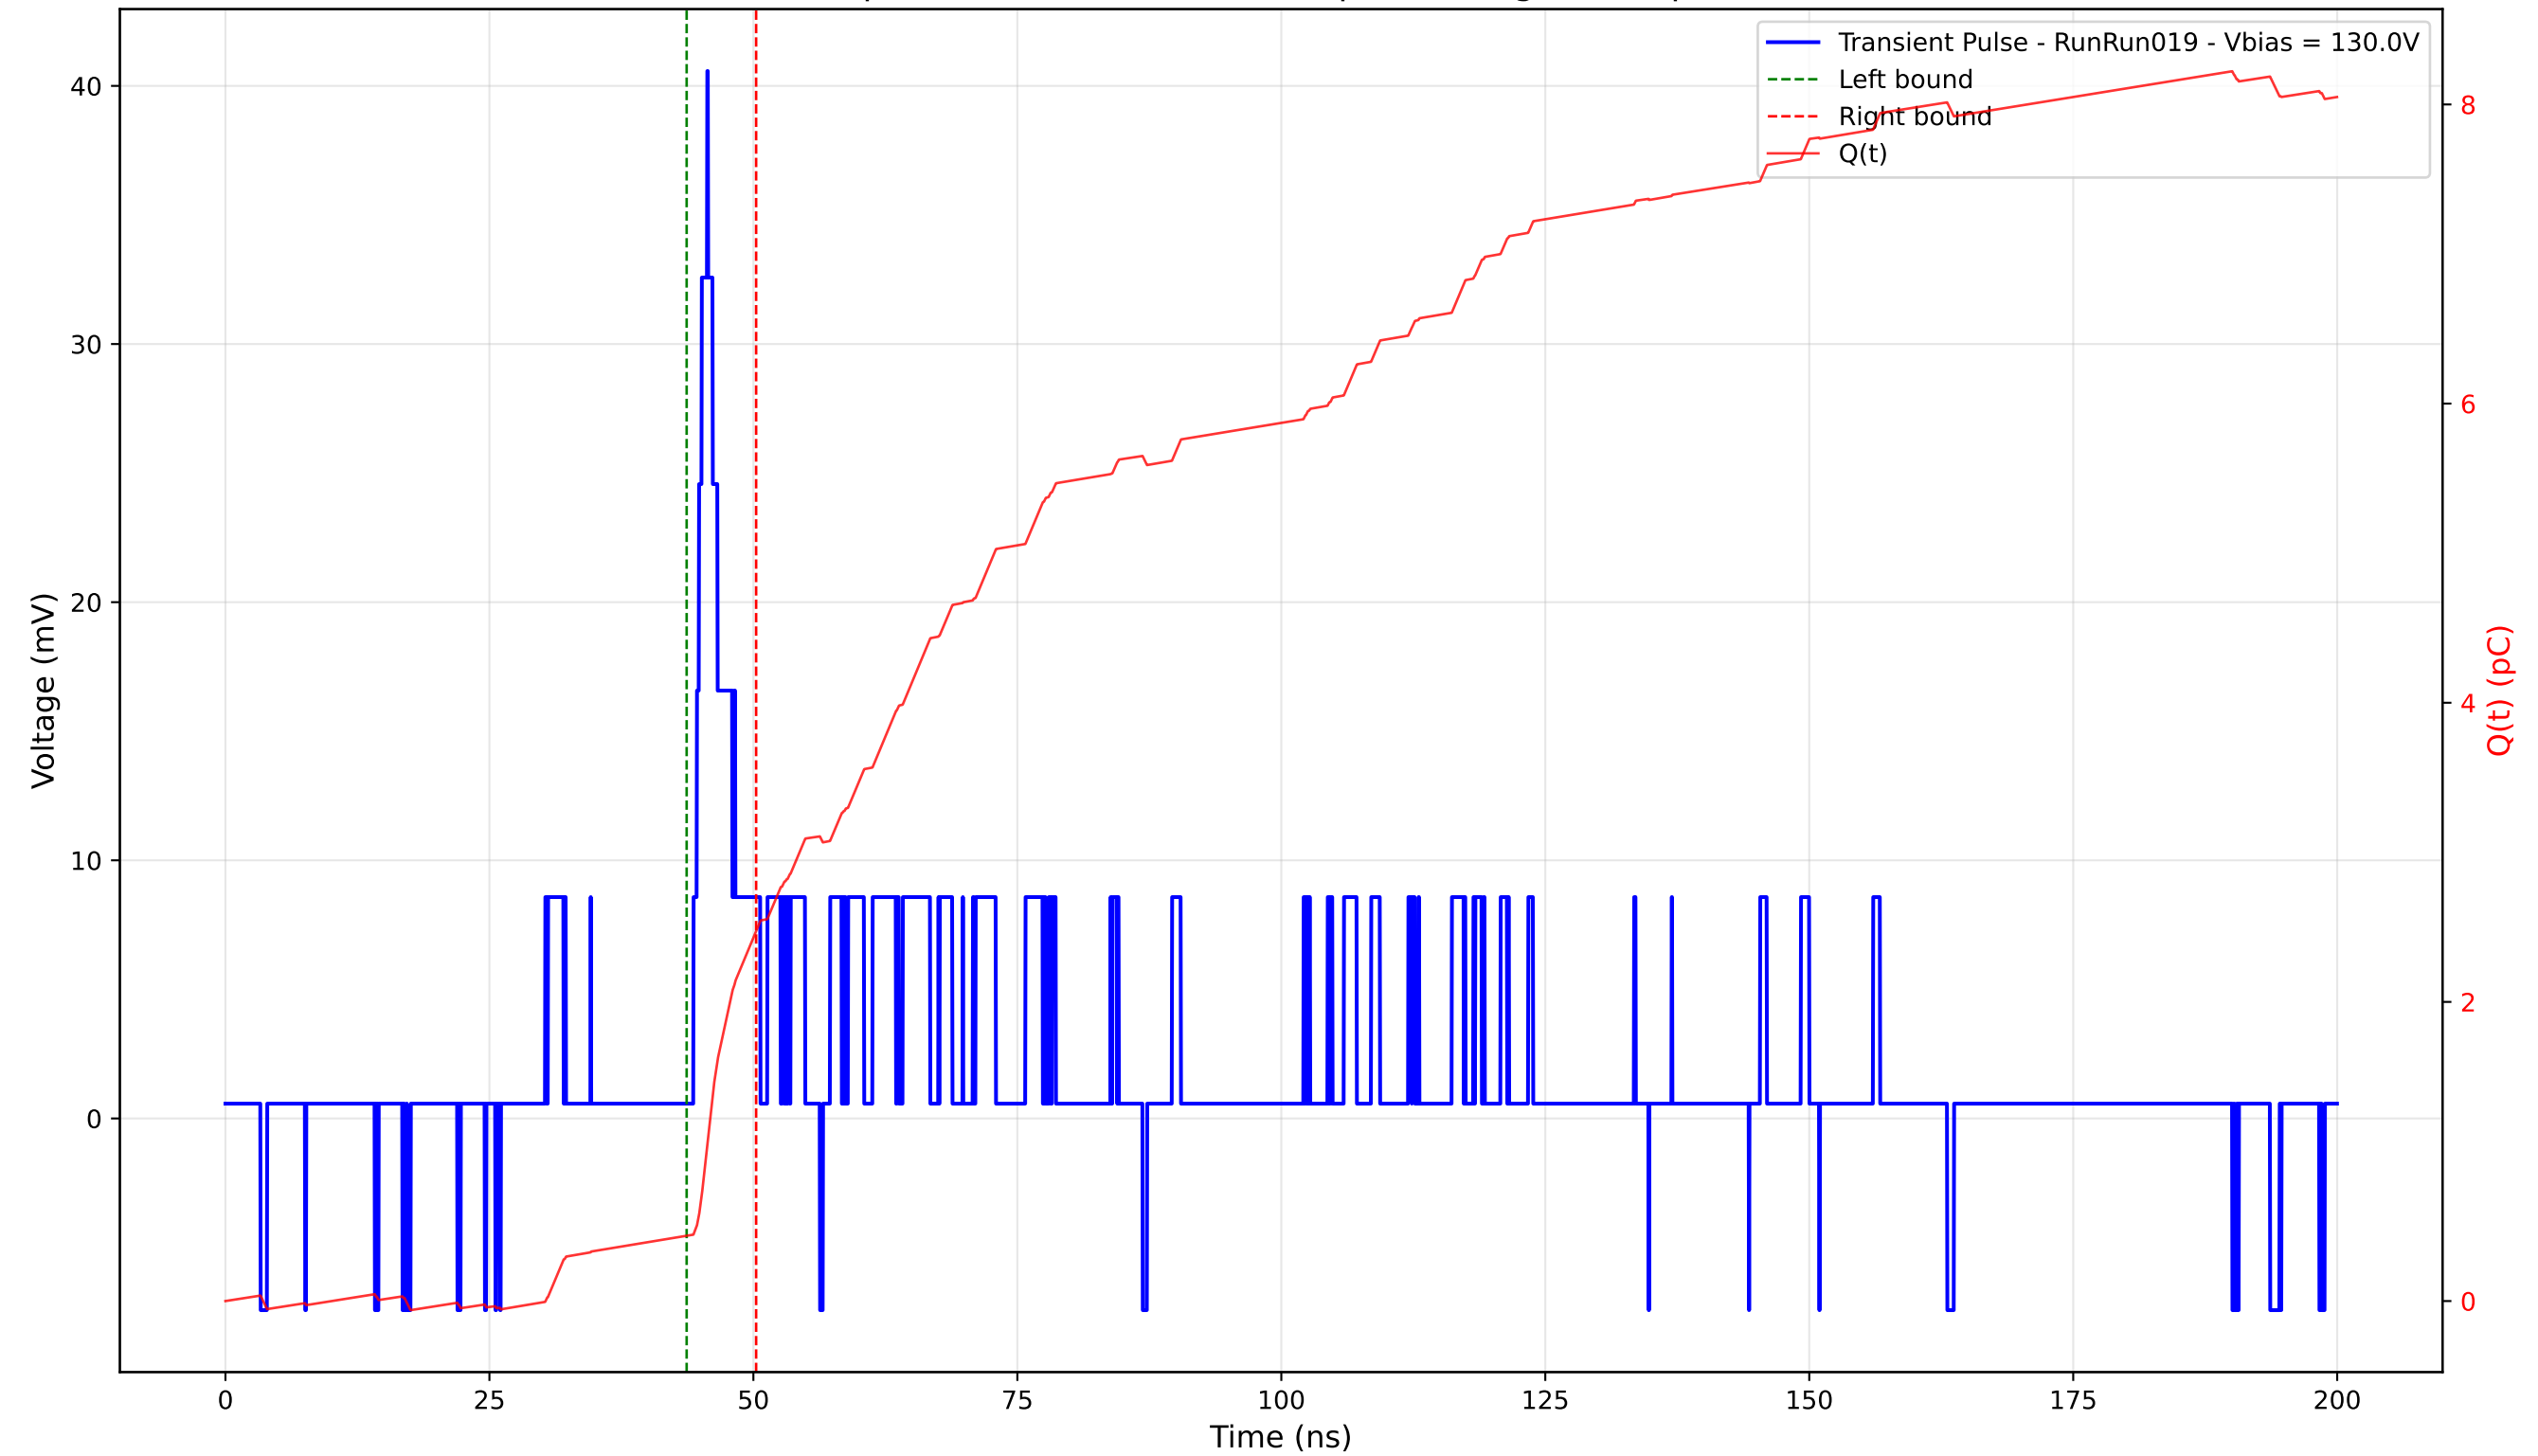


Transient Pulse - Sample: 4003 - Position: 380.0 μm - Charge: 1.82 pC - Rise Time: 0.91 ns

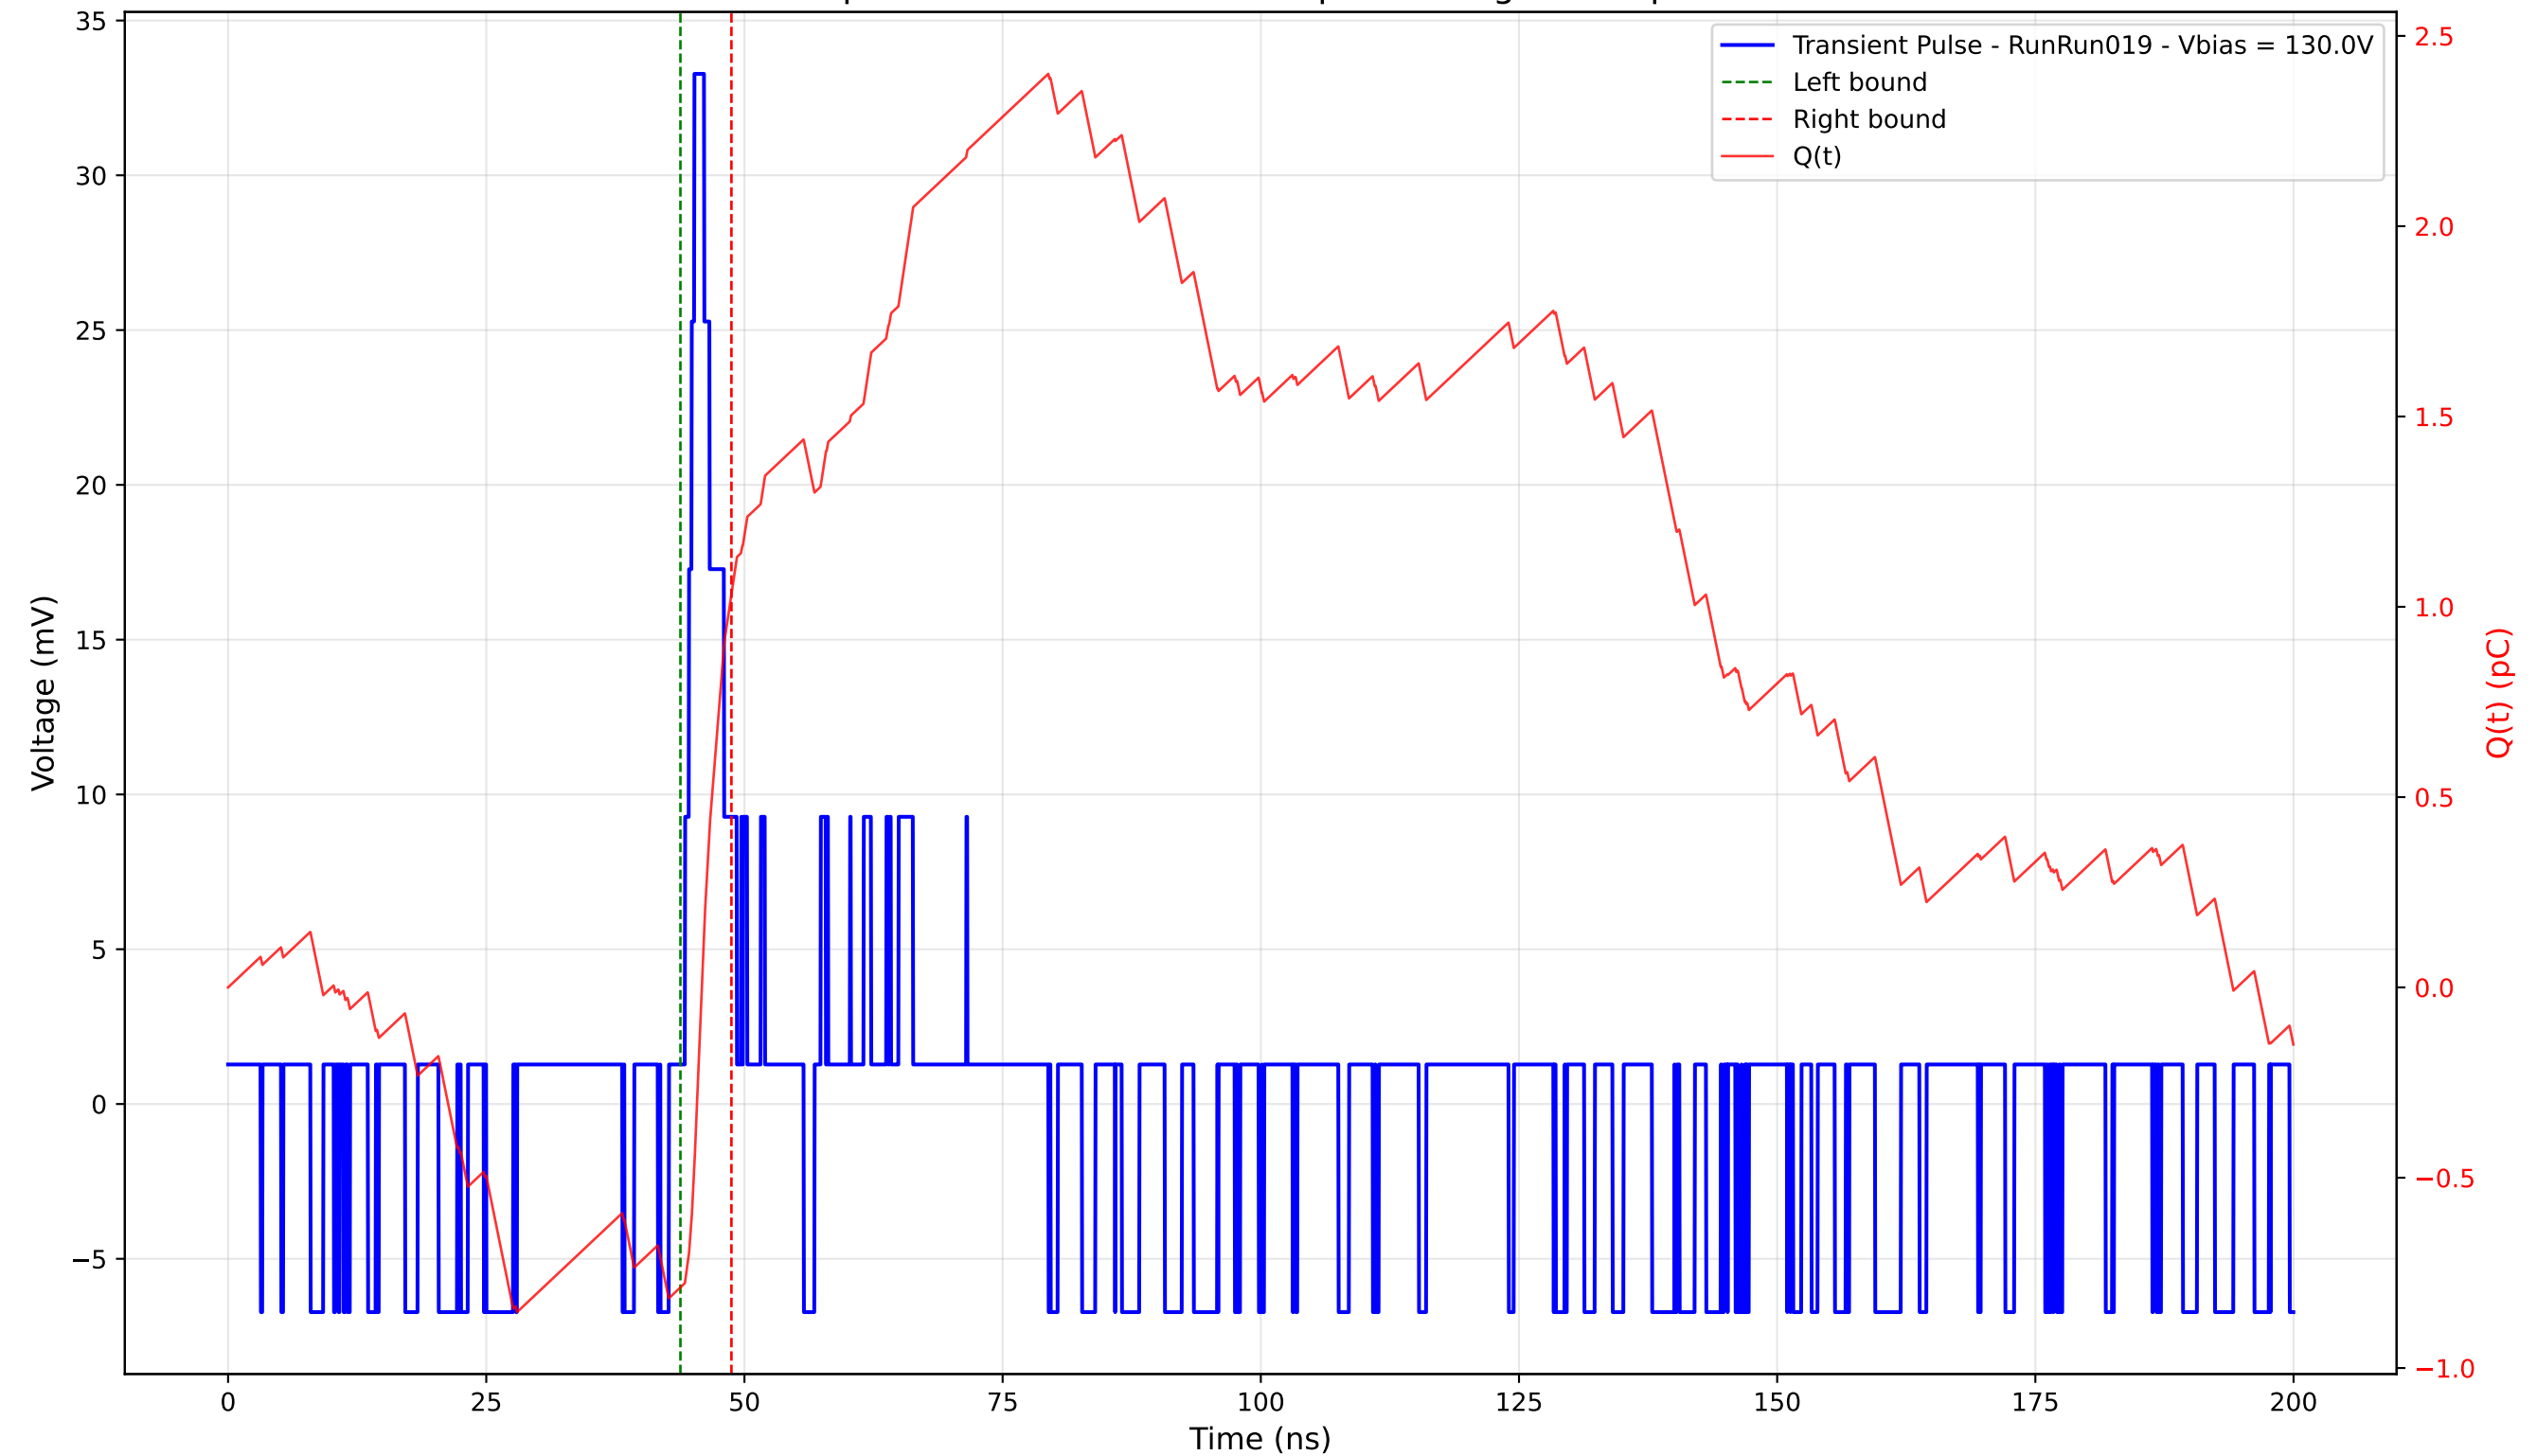


Transient Pulse - Sample: 4003 - Position: 385.0 μm - Charge: 2.82 pC - Rise Time: 2.29 ns

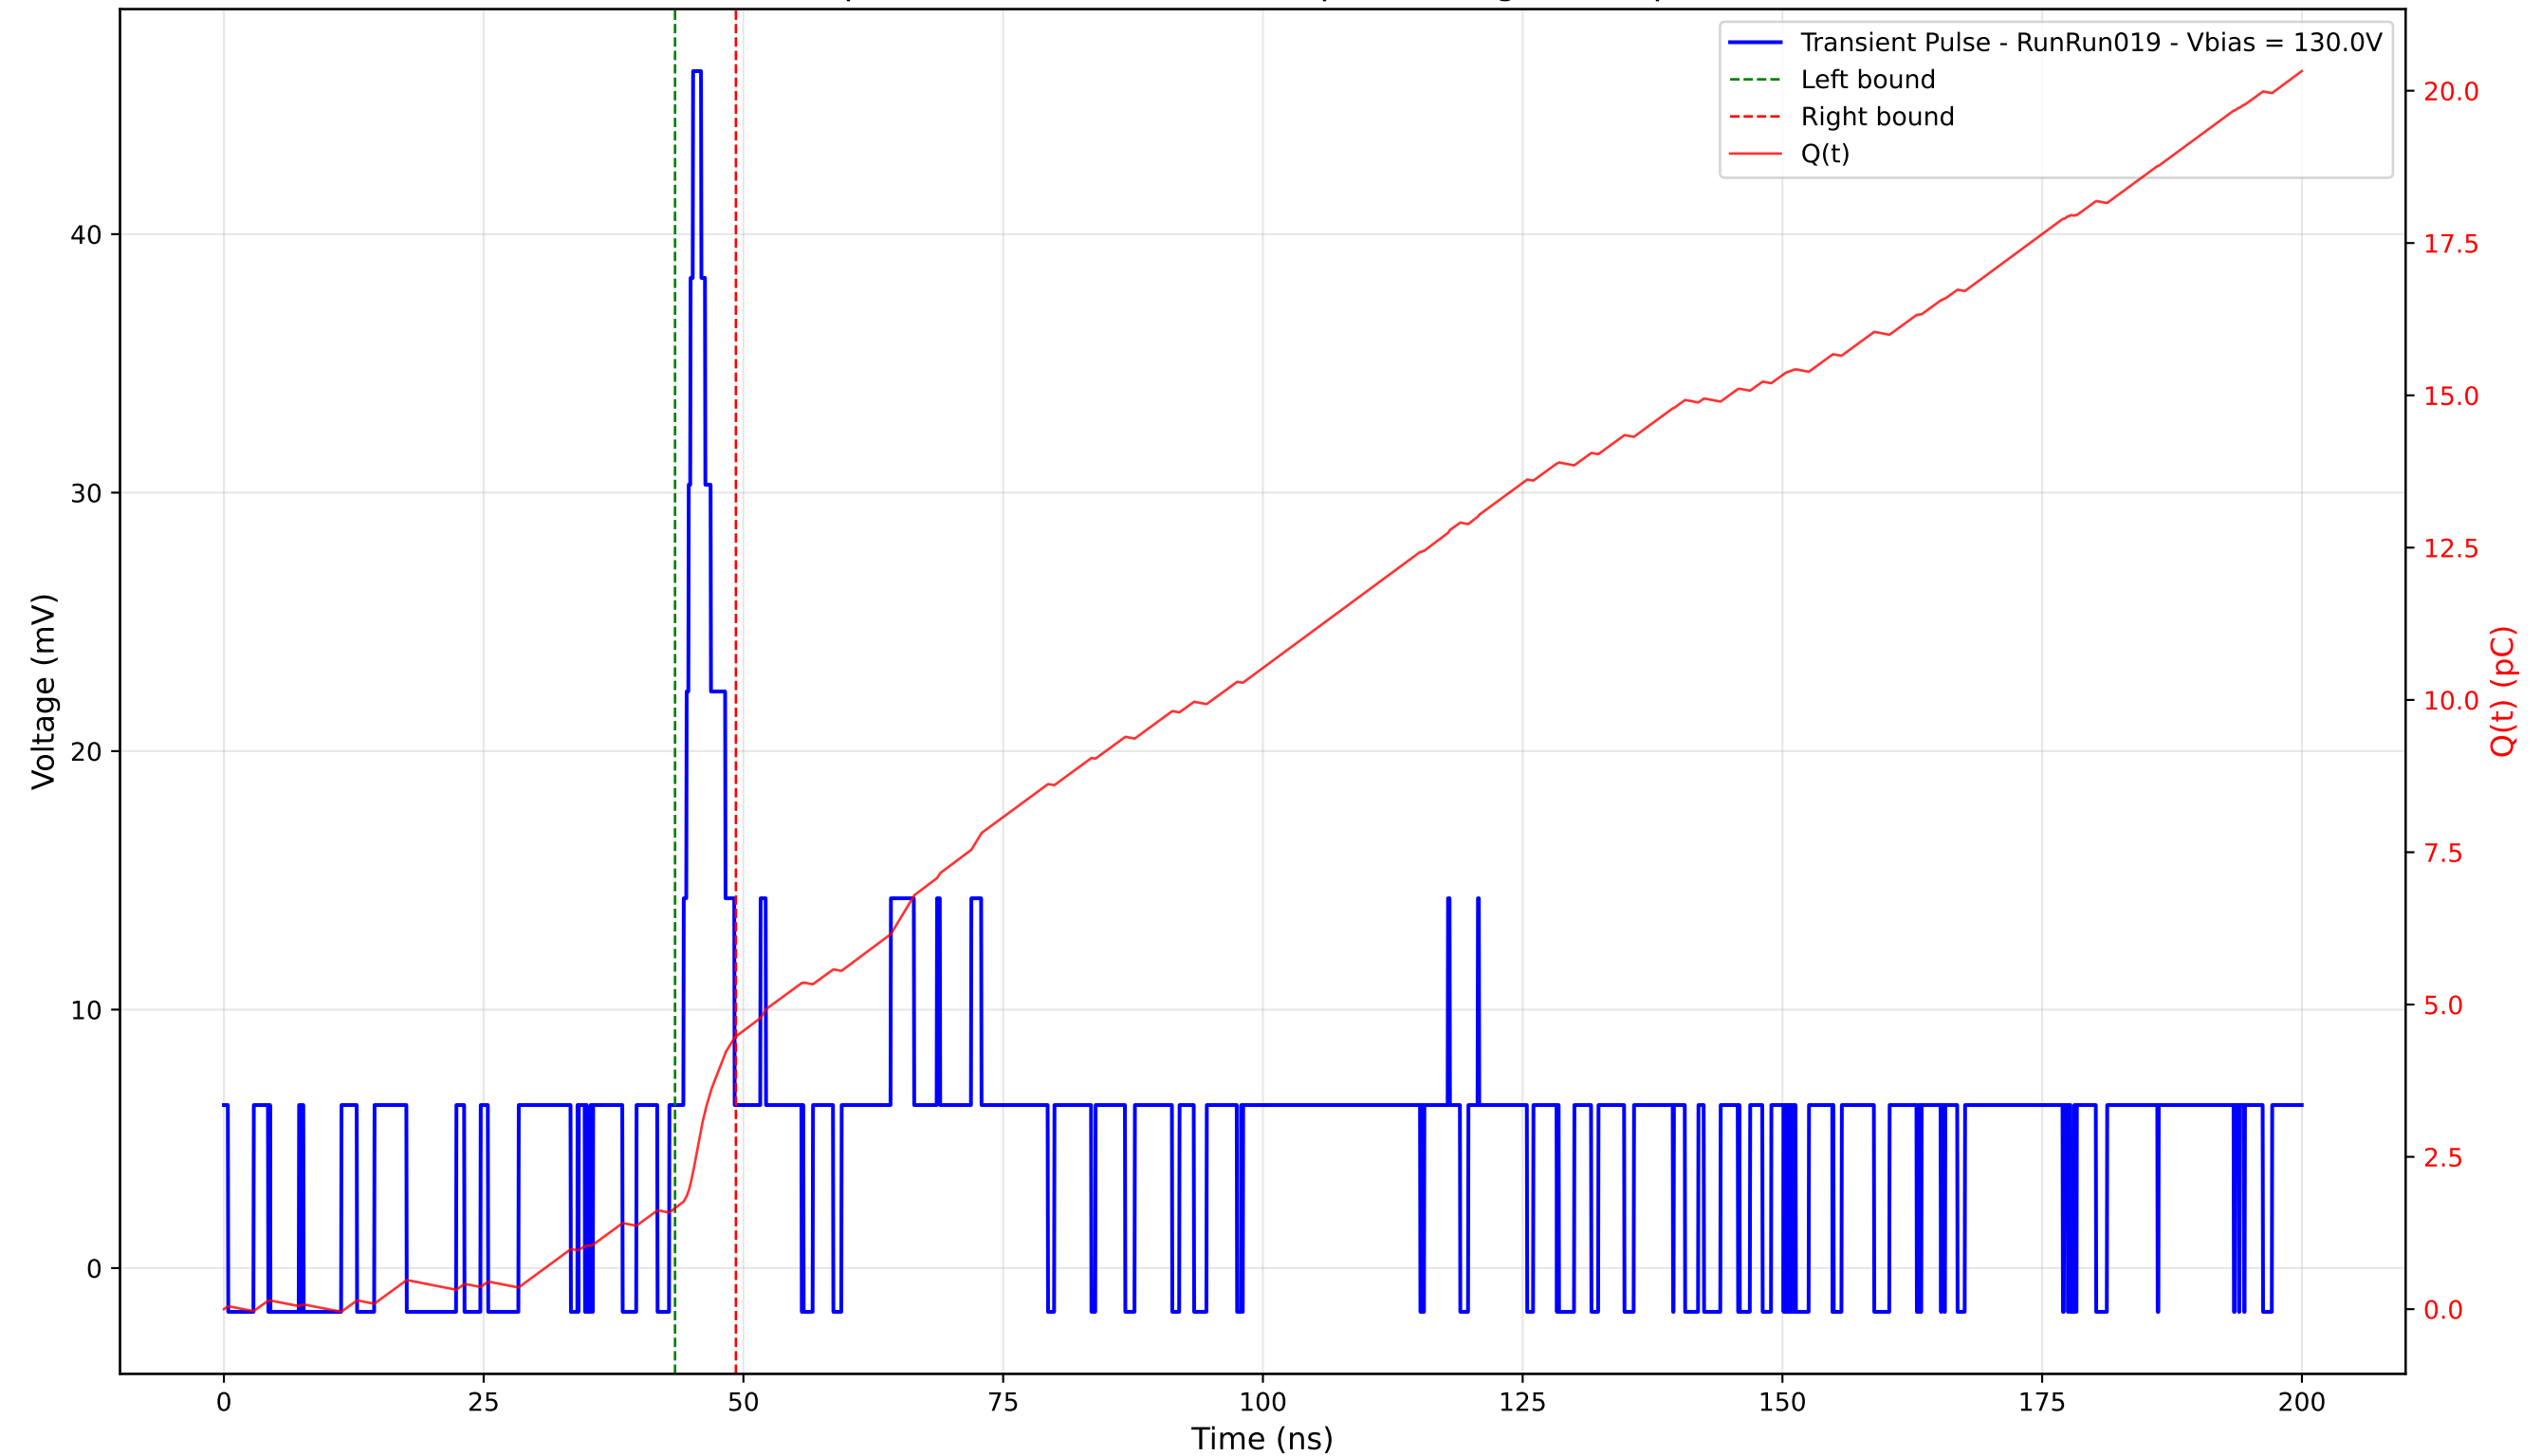


Transient Pulse - Sample: 4003 - Position: 390.0 μm - Charge: 2.66 pC - Rise Time: 1.00 ns

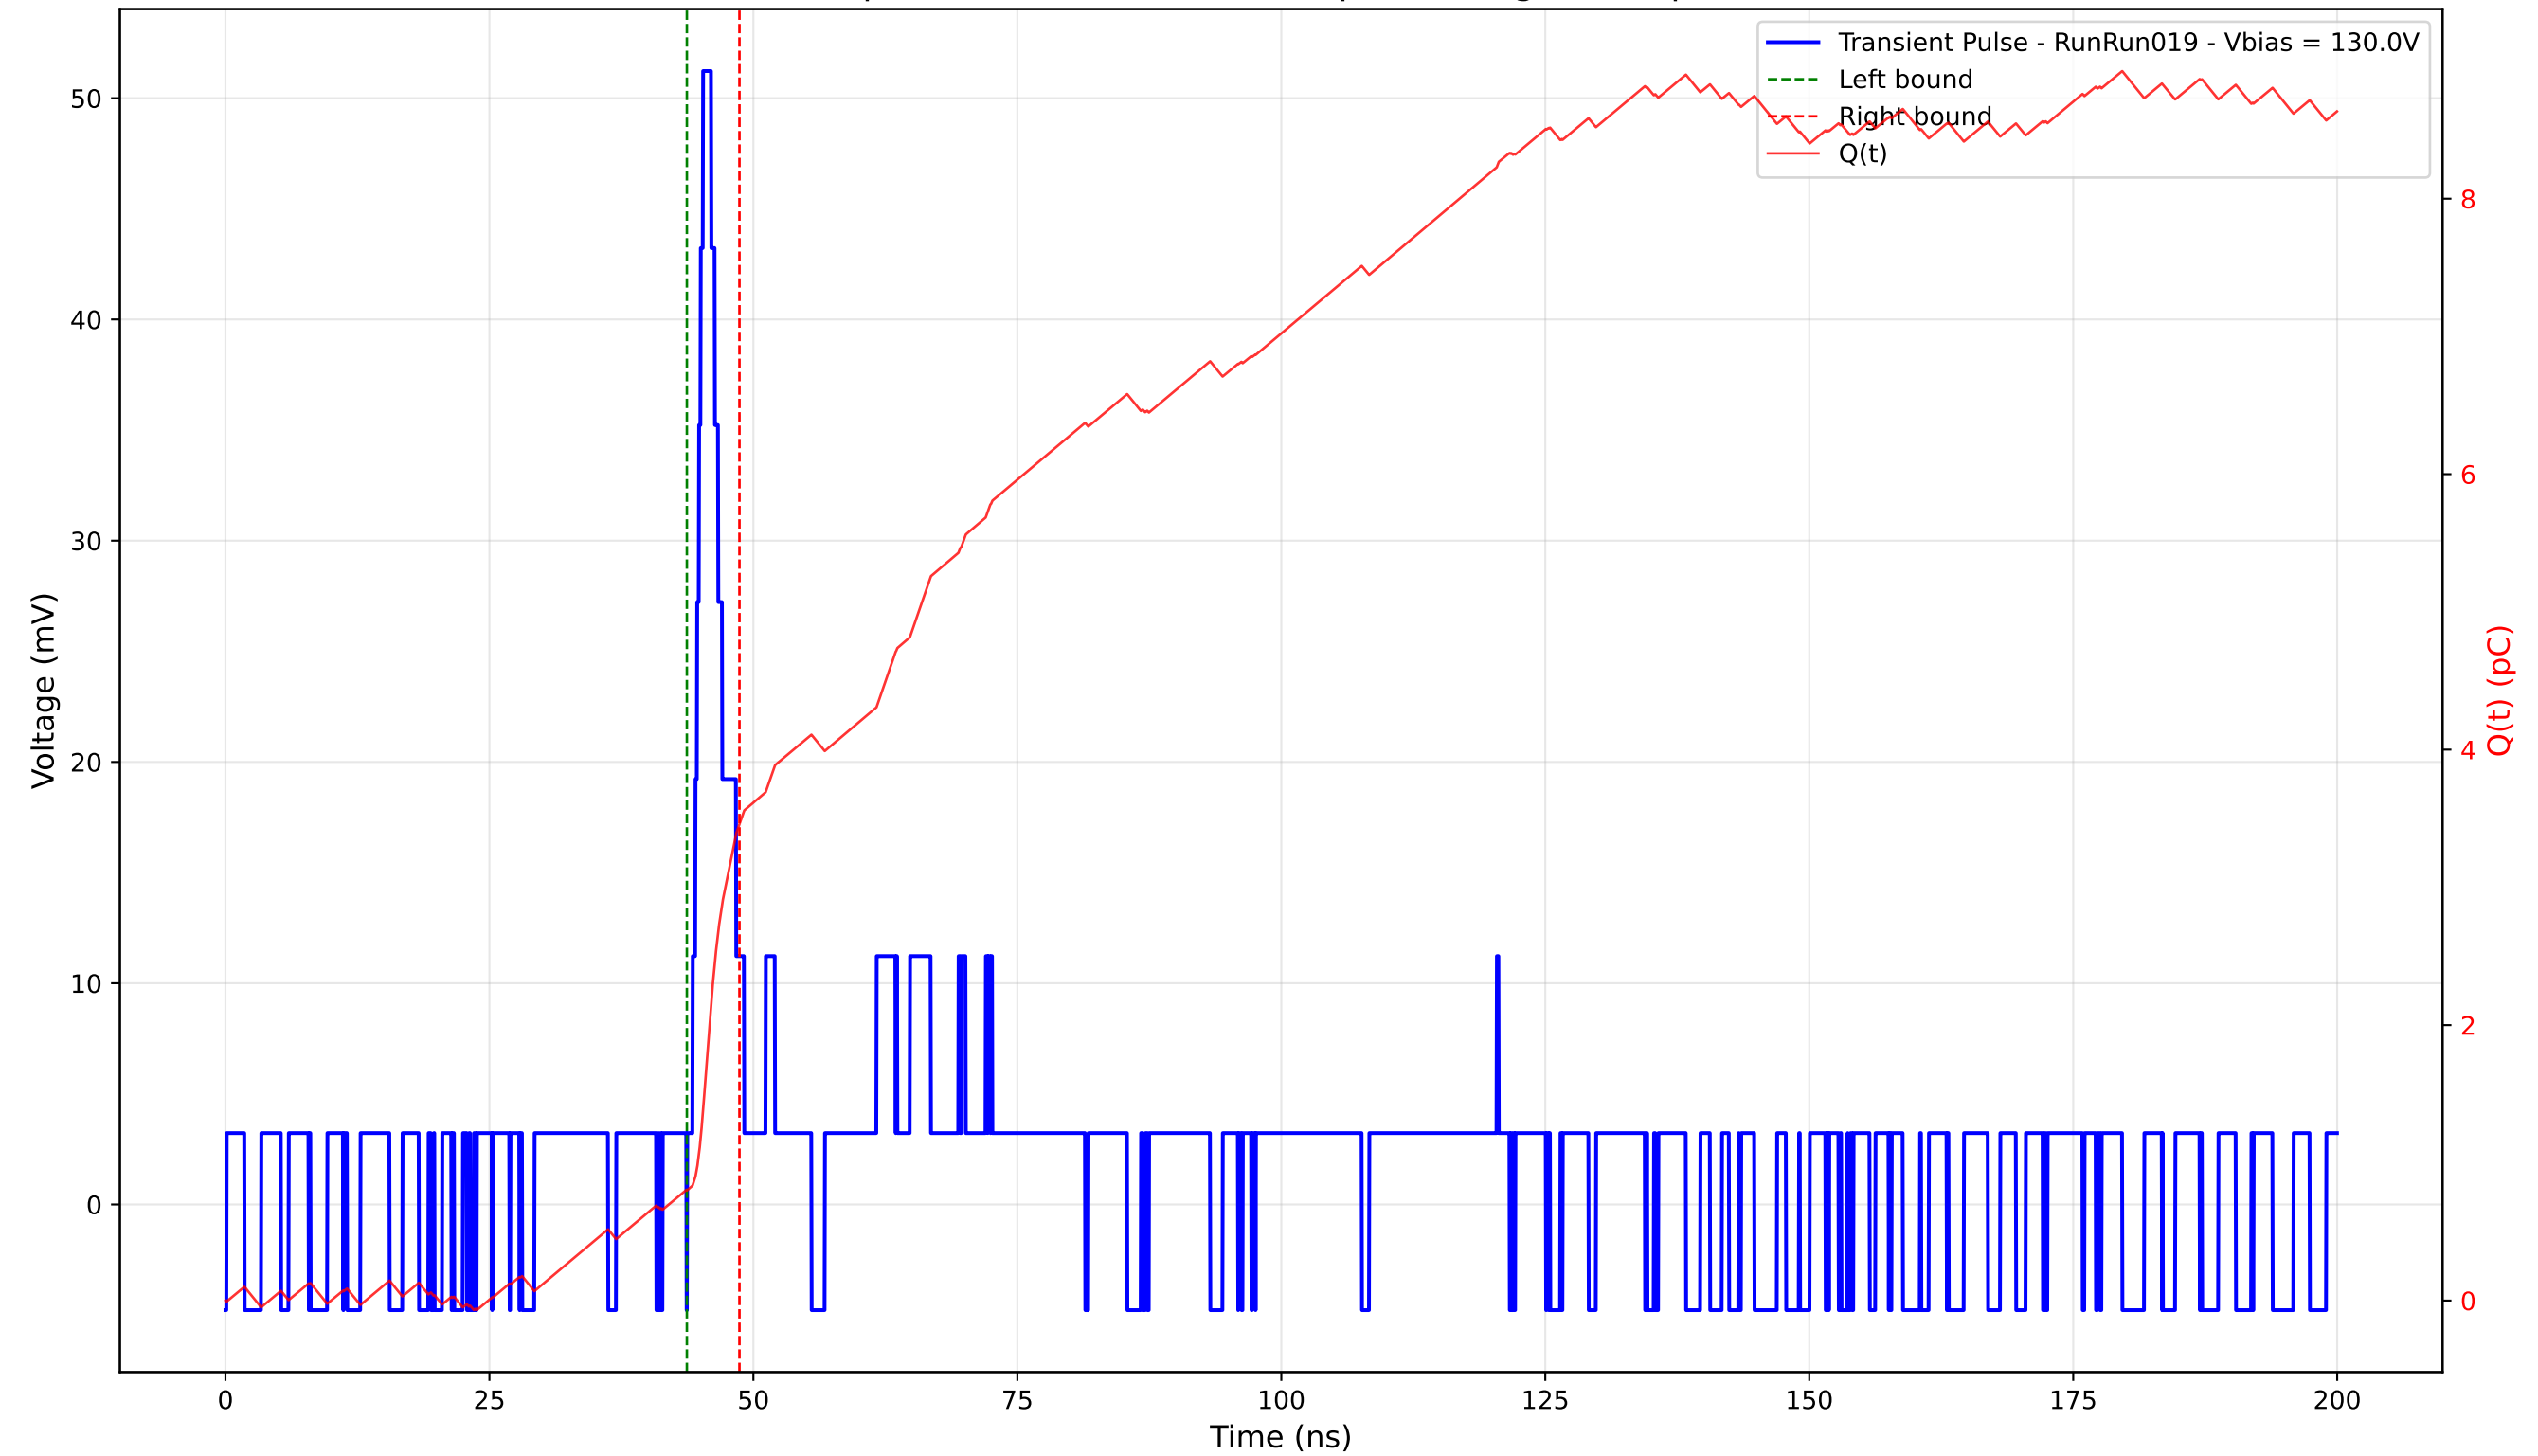


Transient Pulse - Sample: 4003 - Position: 395.0 μm - Charge: 2.86 pC - Rise Time: 1.04 ns

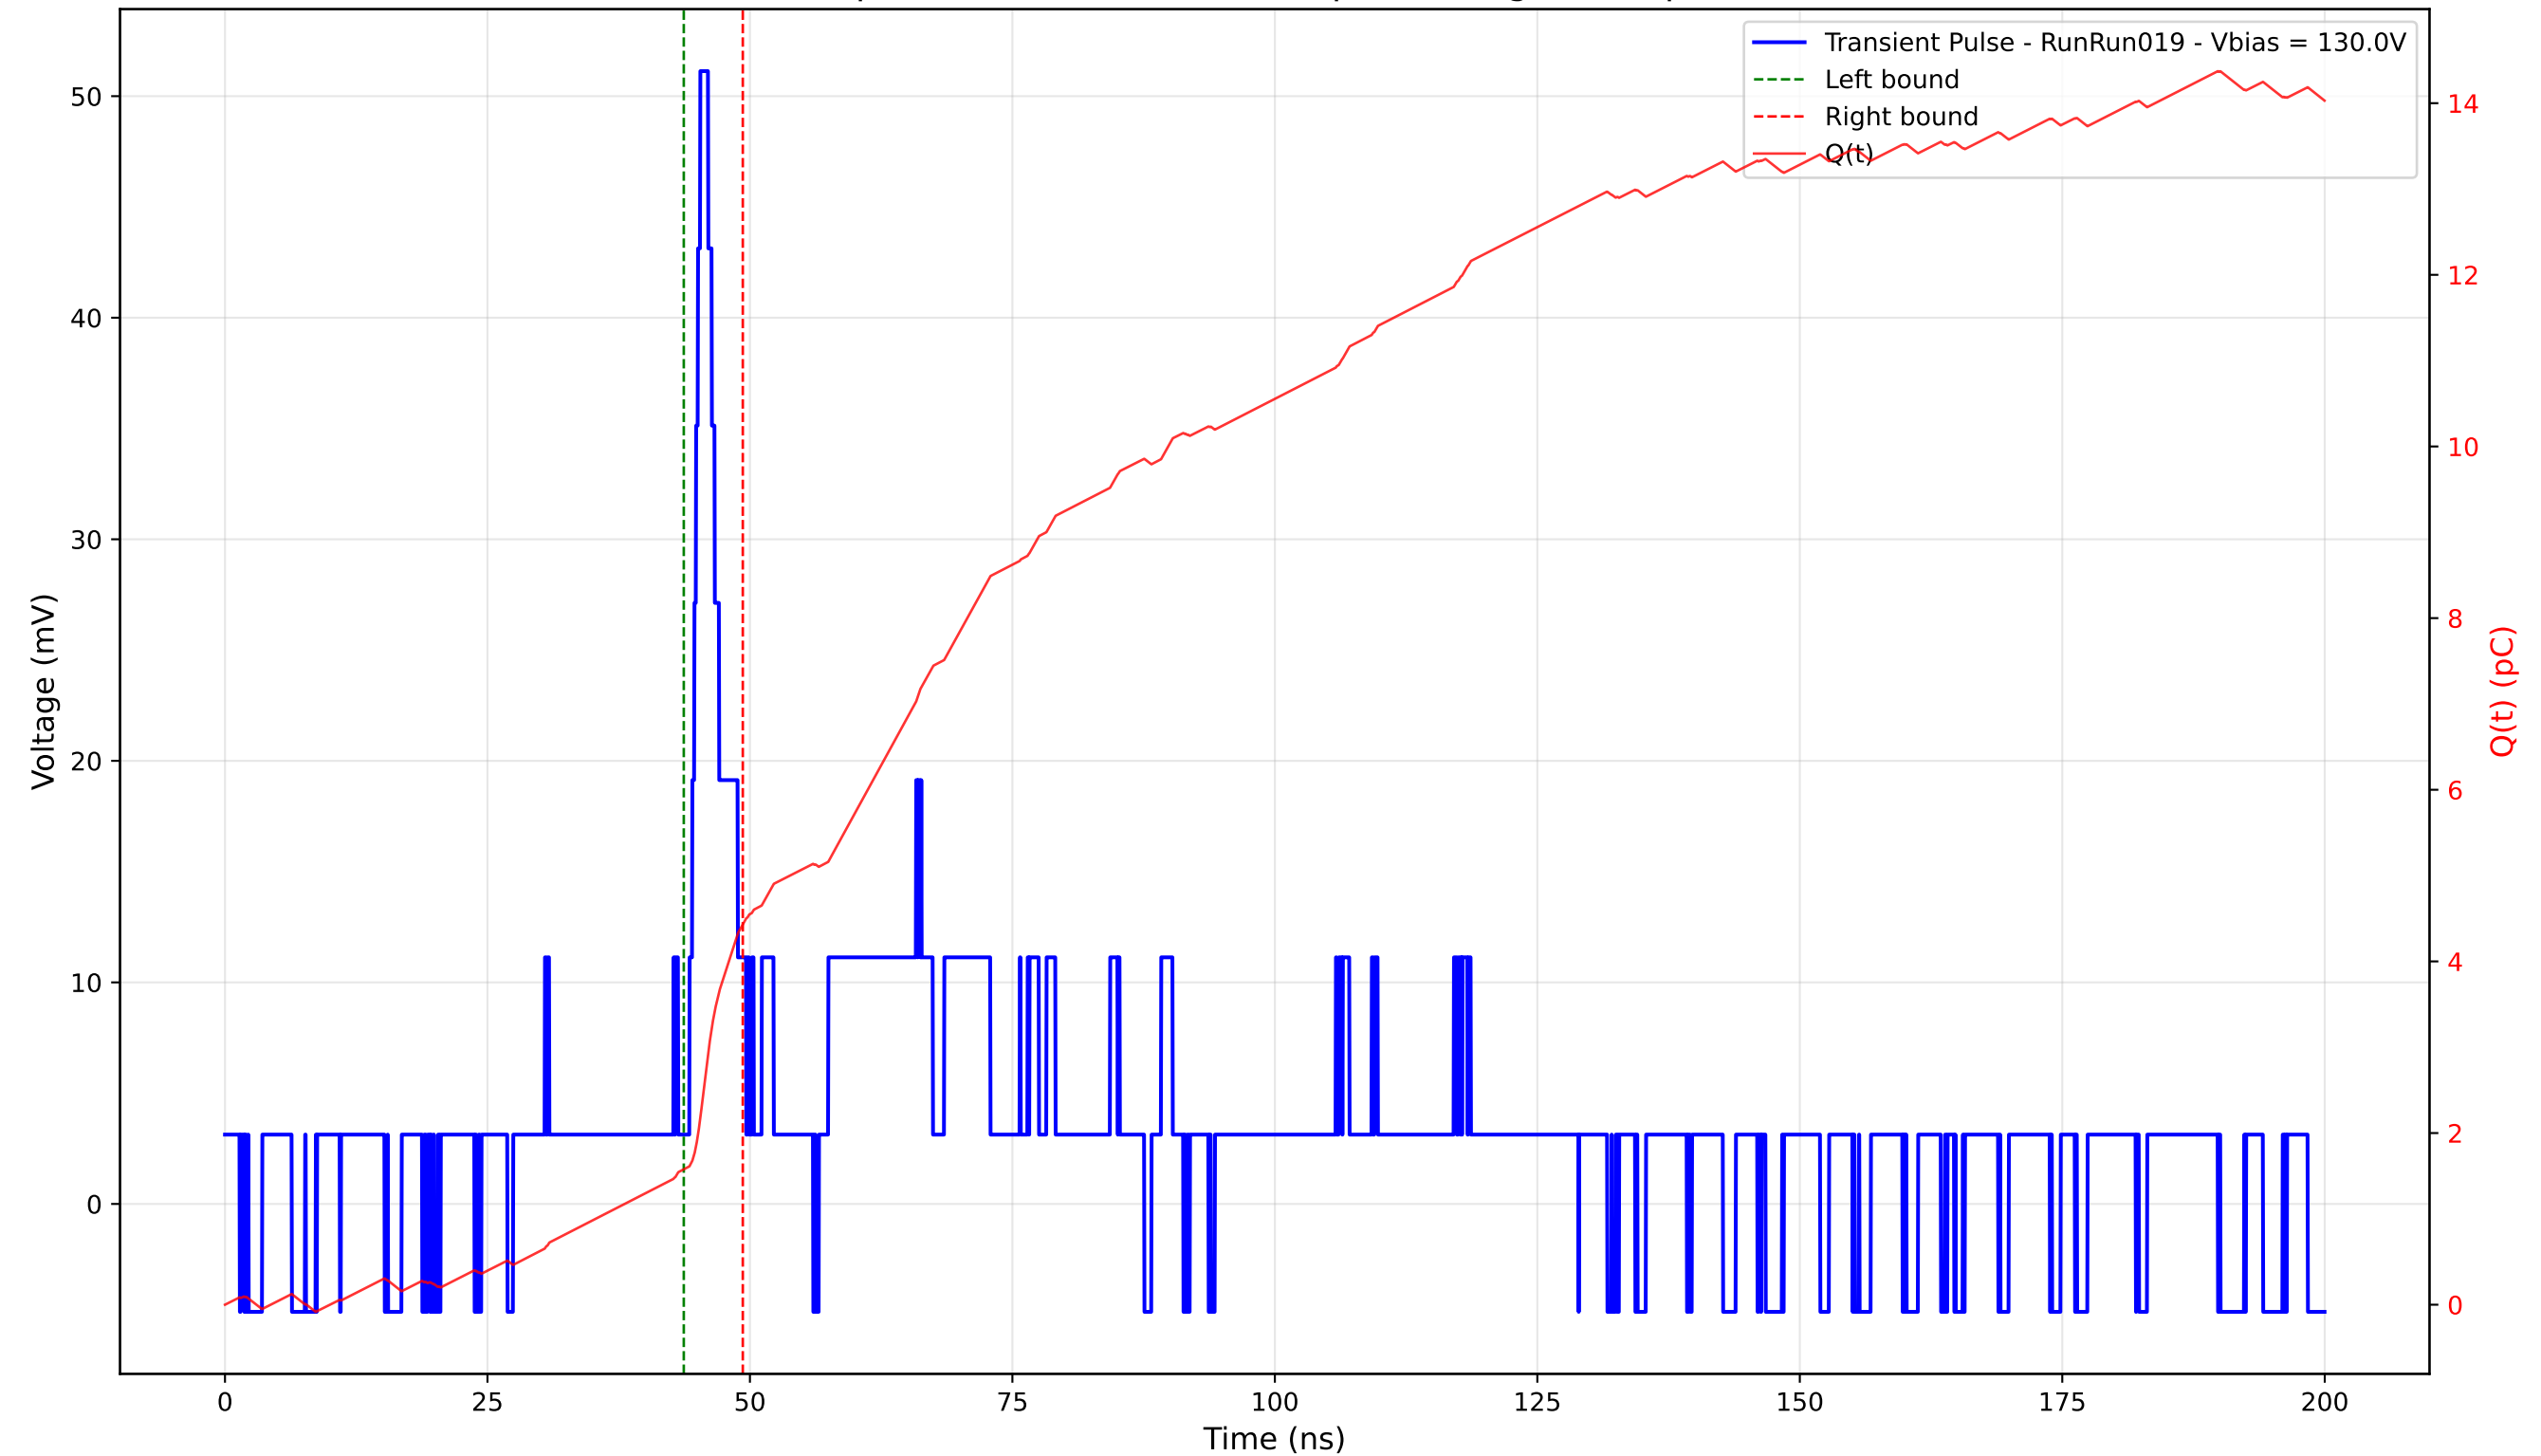


Transient Pulse - Sample: 4003 - Position: 400.0 μm - Charge: 2.59 pC - Rise Time: 0.86 ns

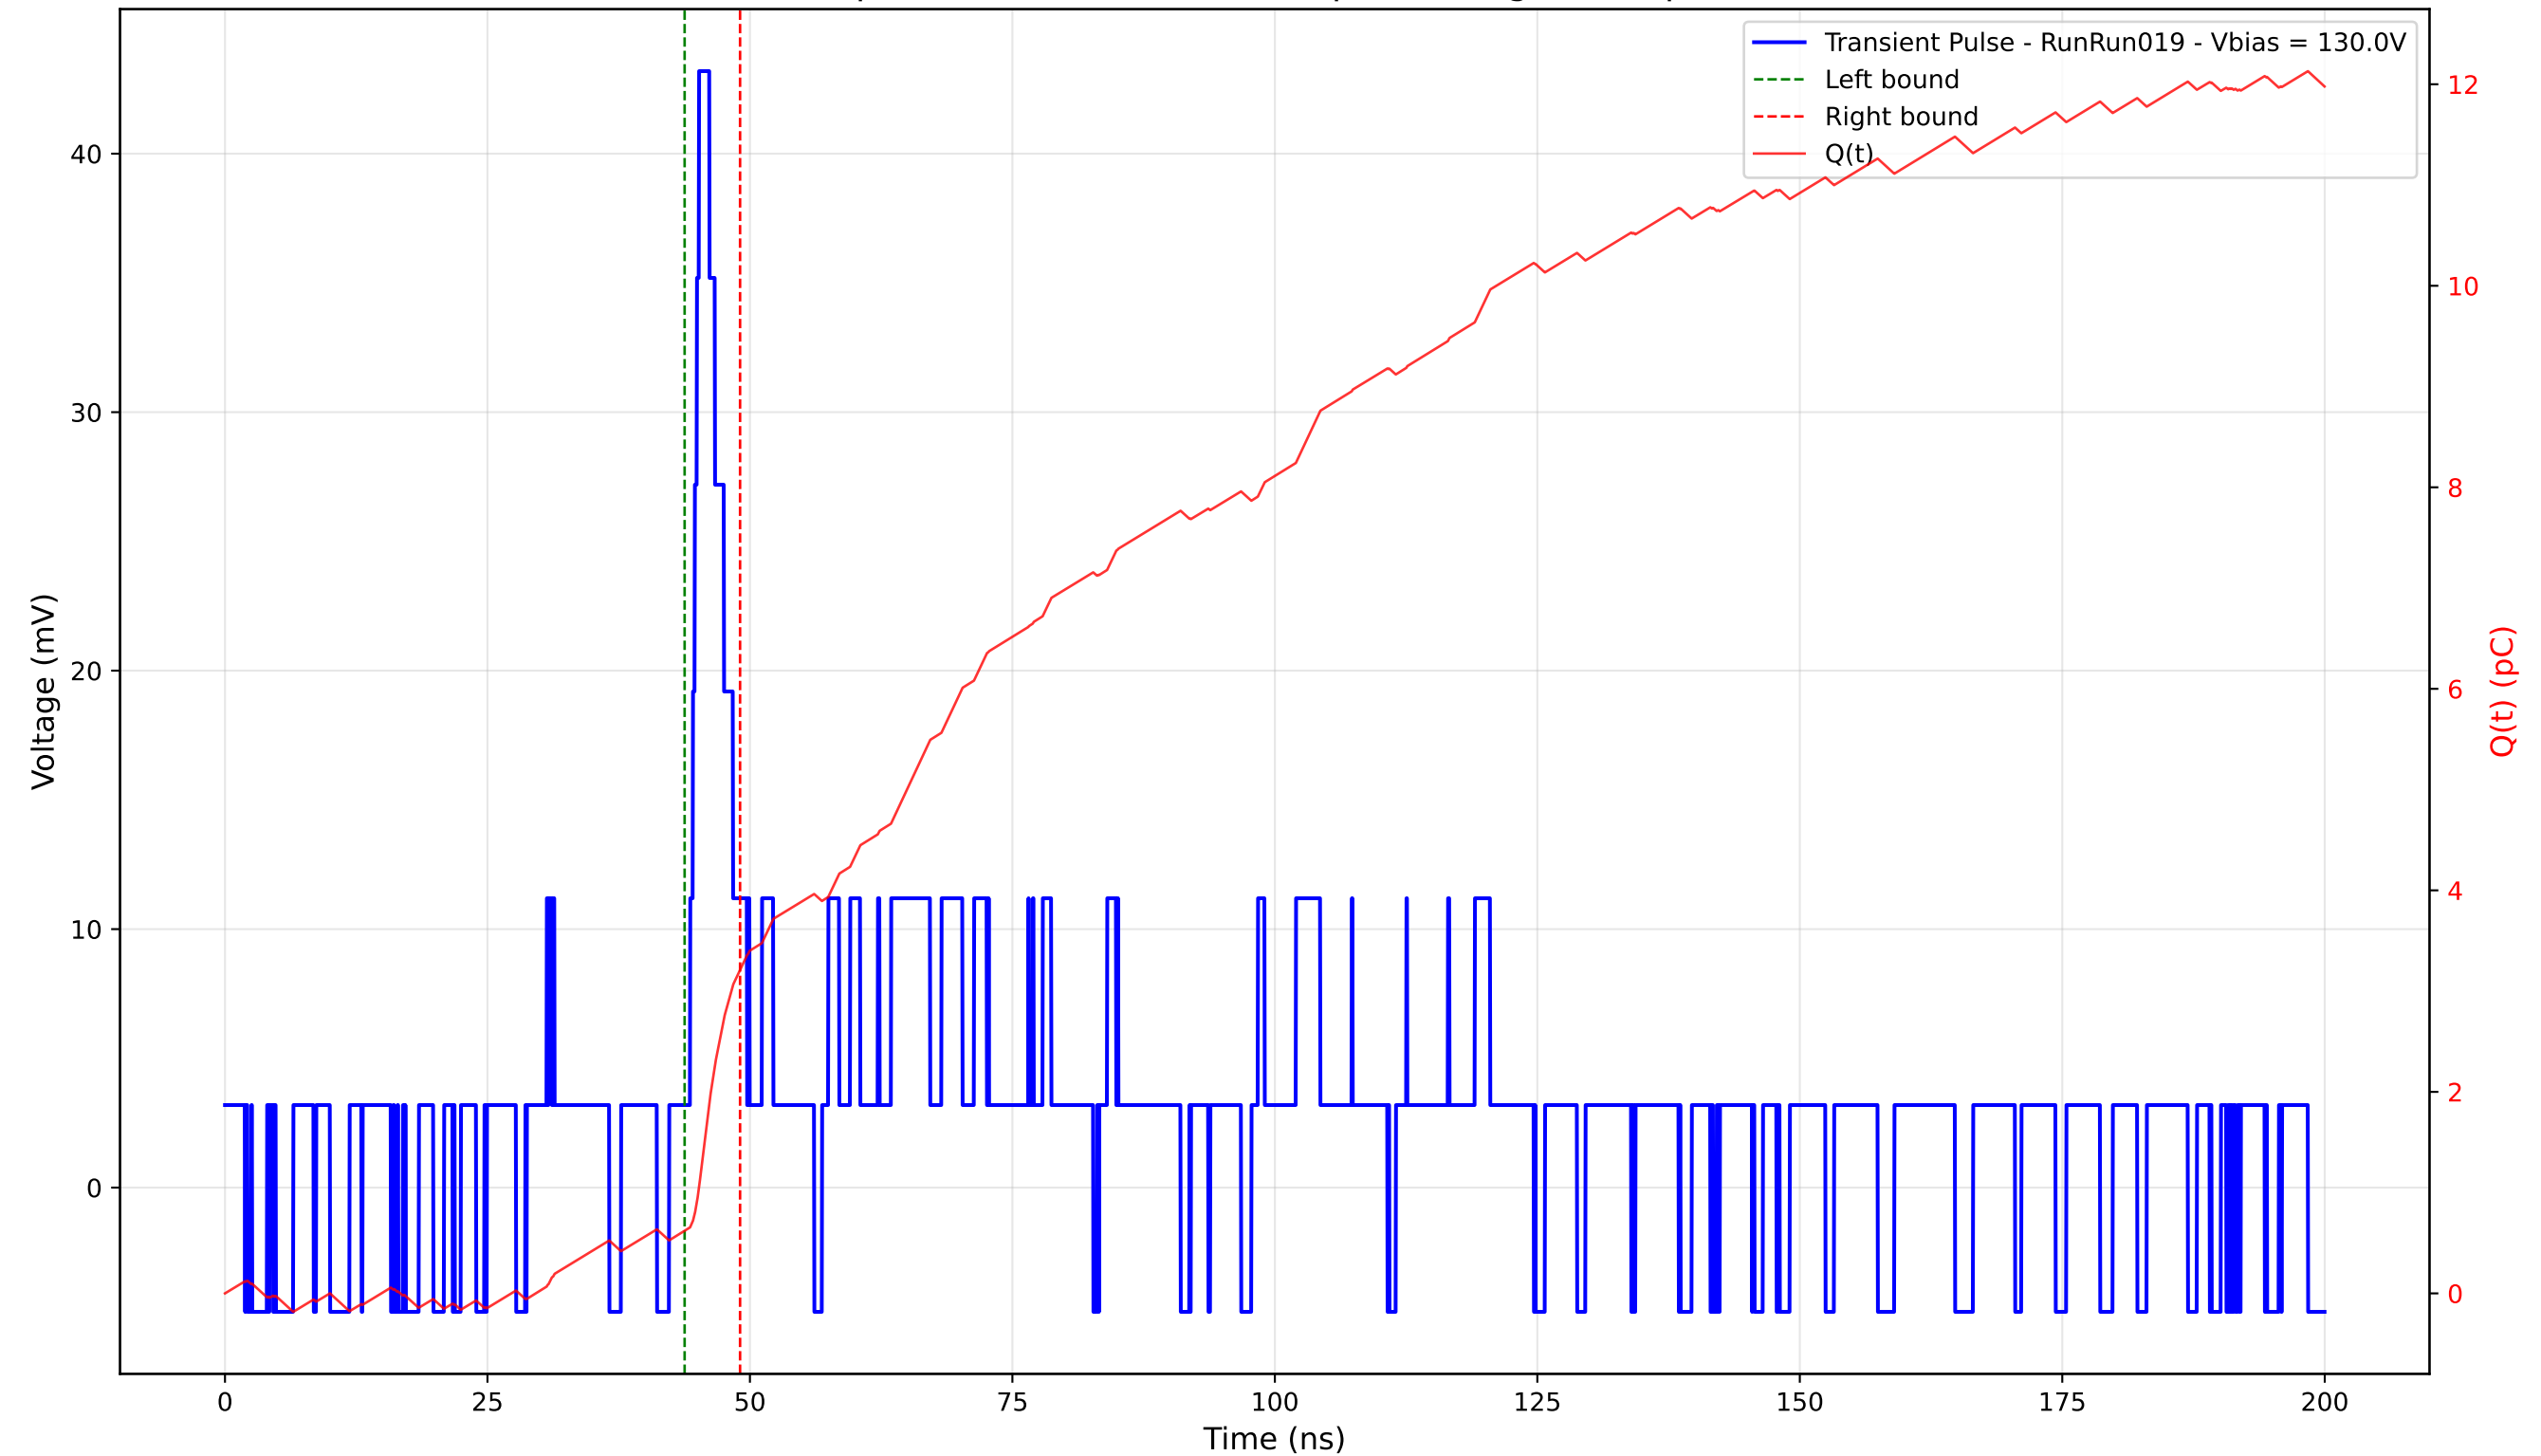


Transient Pulse - Sample: 4003 - Position: 405.0 μm - Charge: 2.21 pC - Rise Time: 1.01 ns

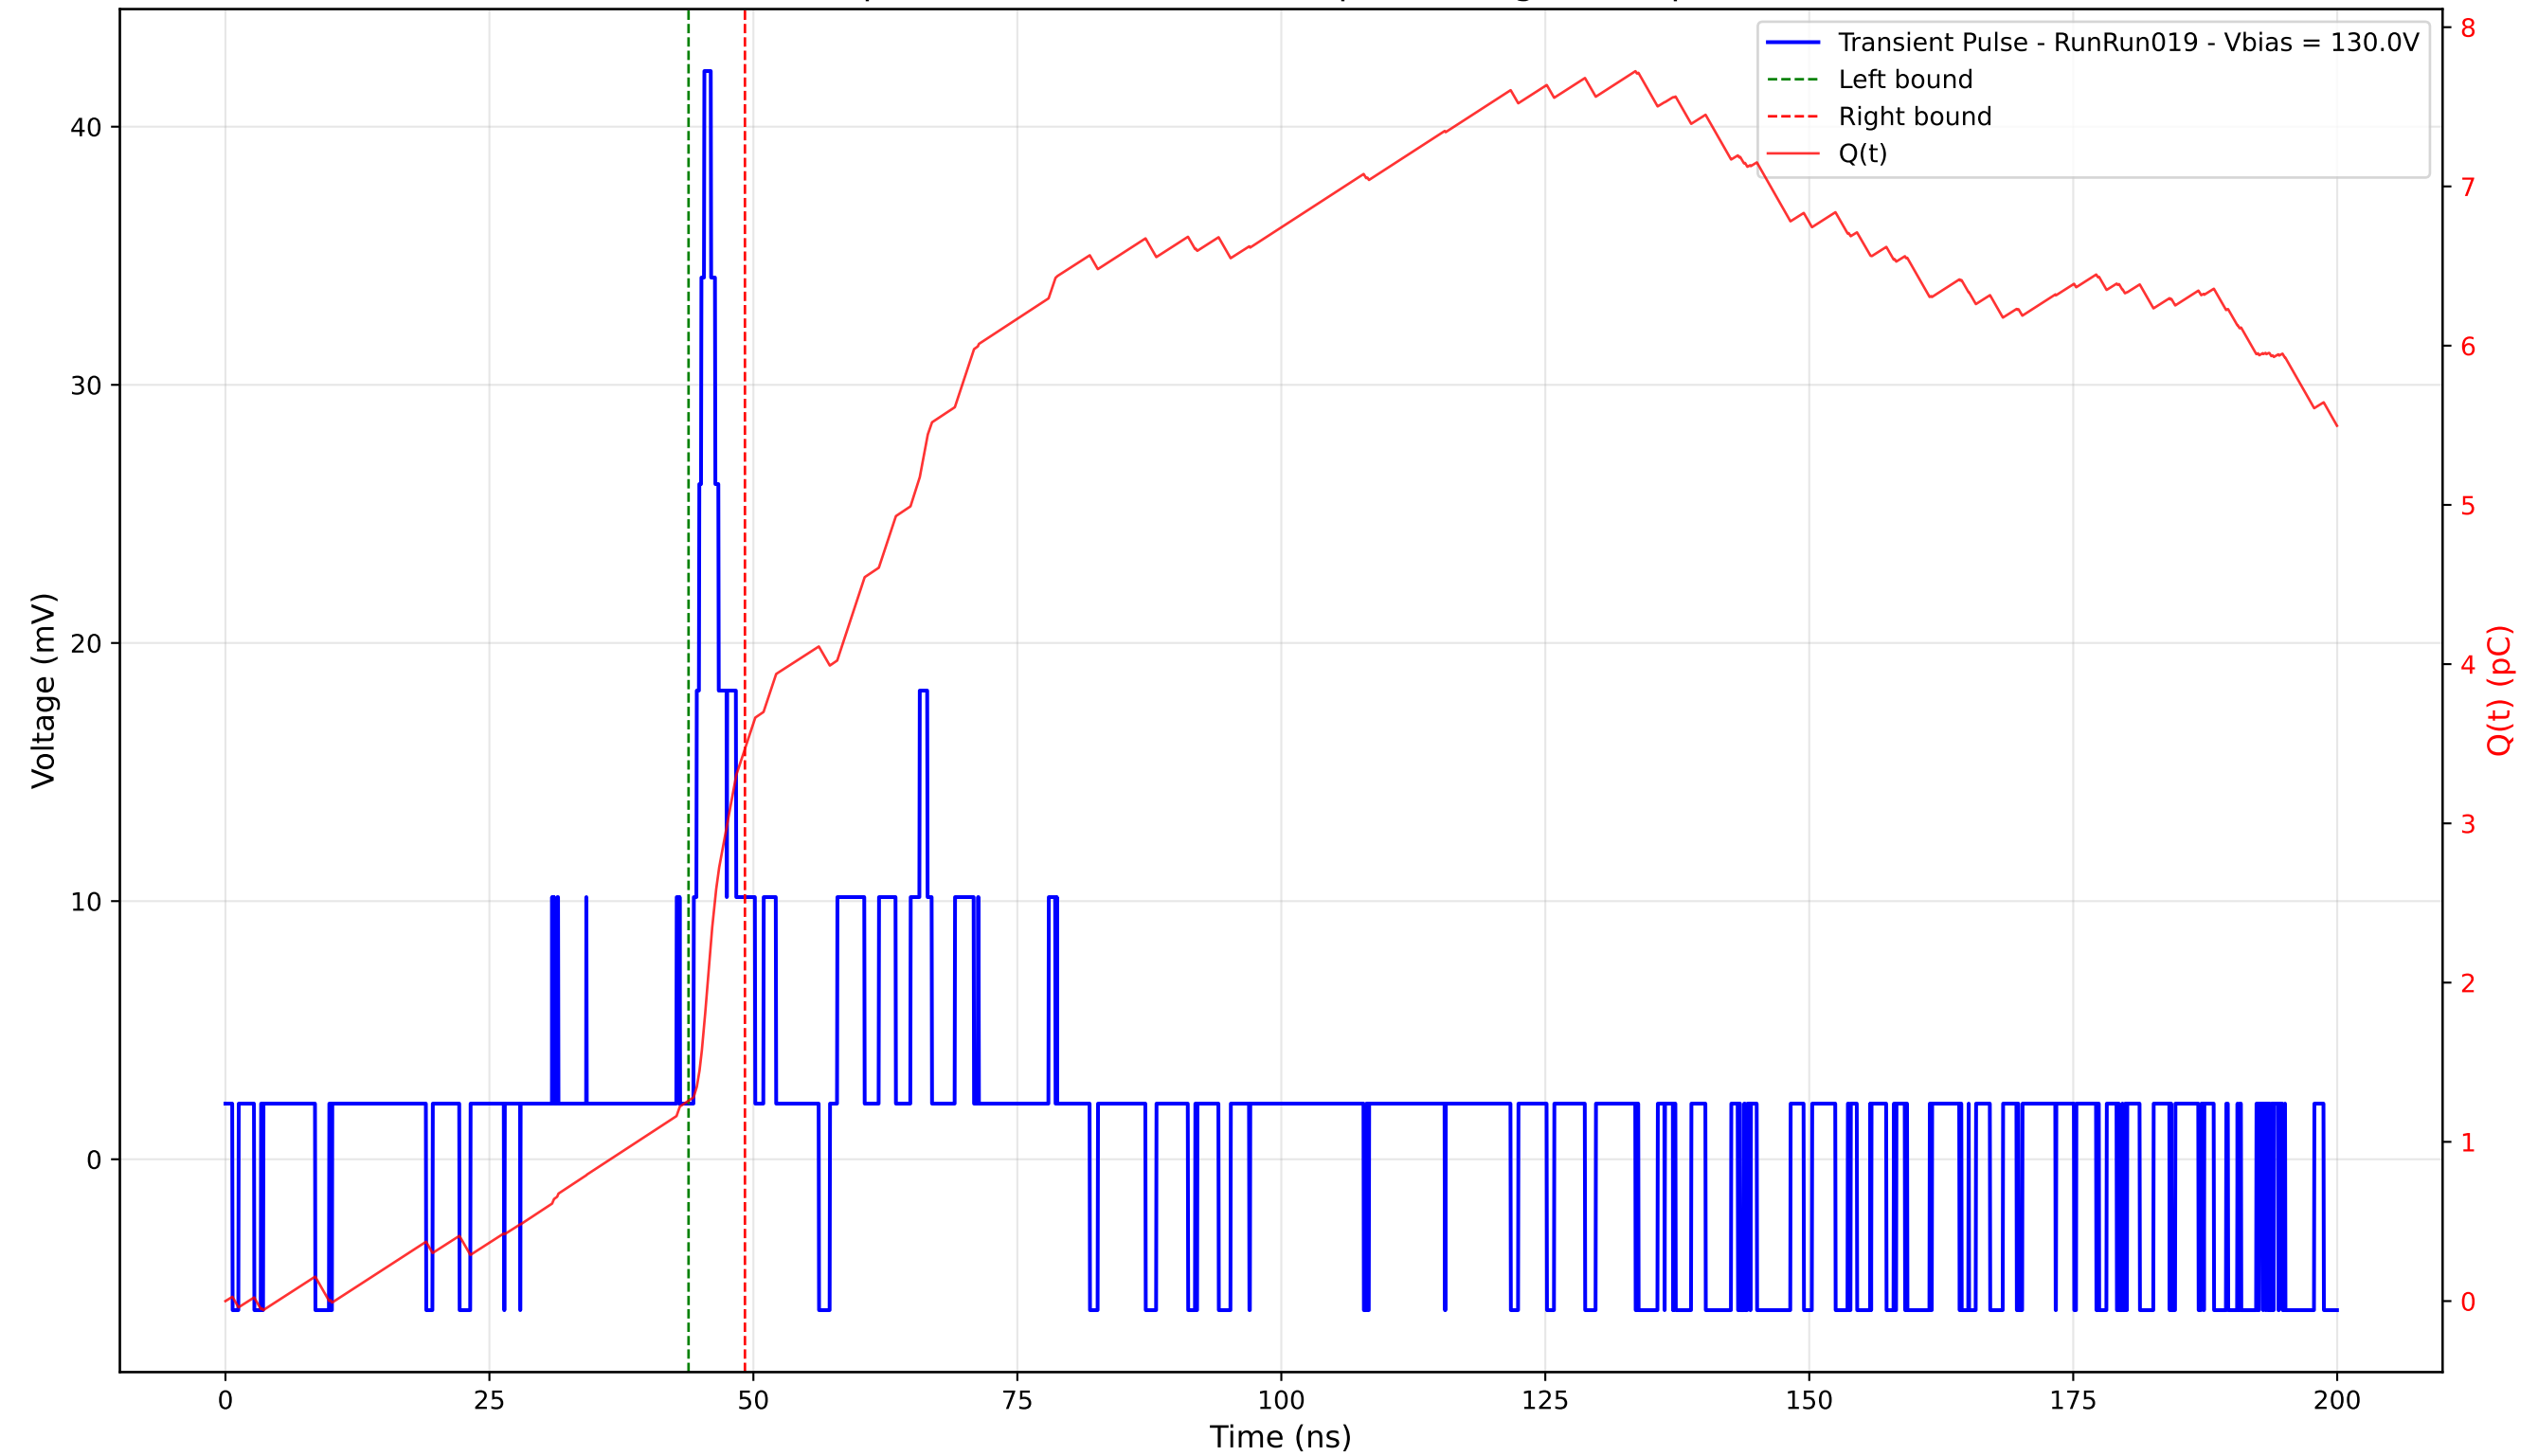


Transient Pulse - Sample: 4003 - Position: 410.0 μm - Charge: 1.97 pC - Rise Time: 1.37 ns

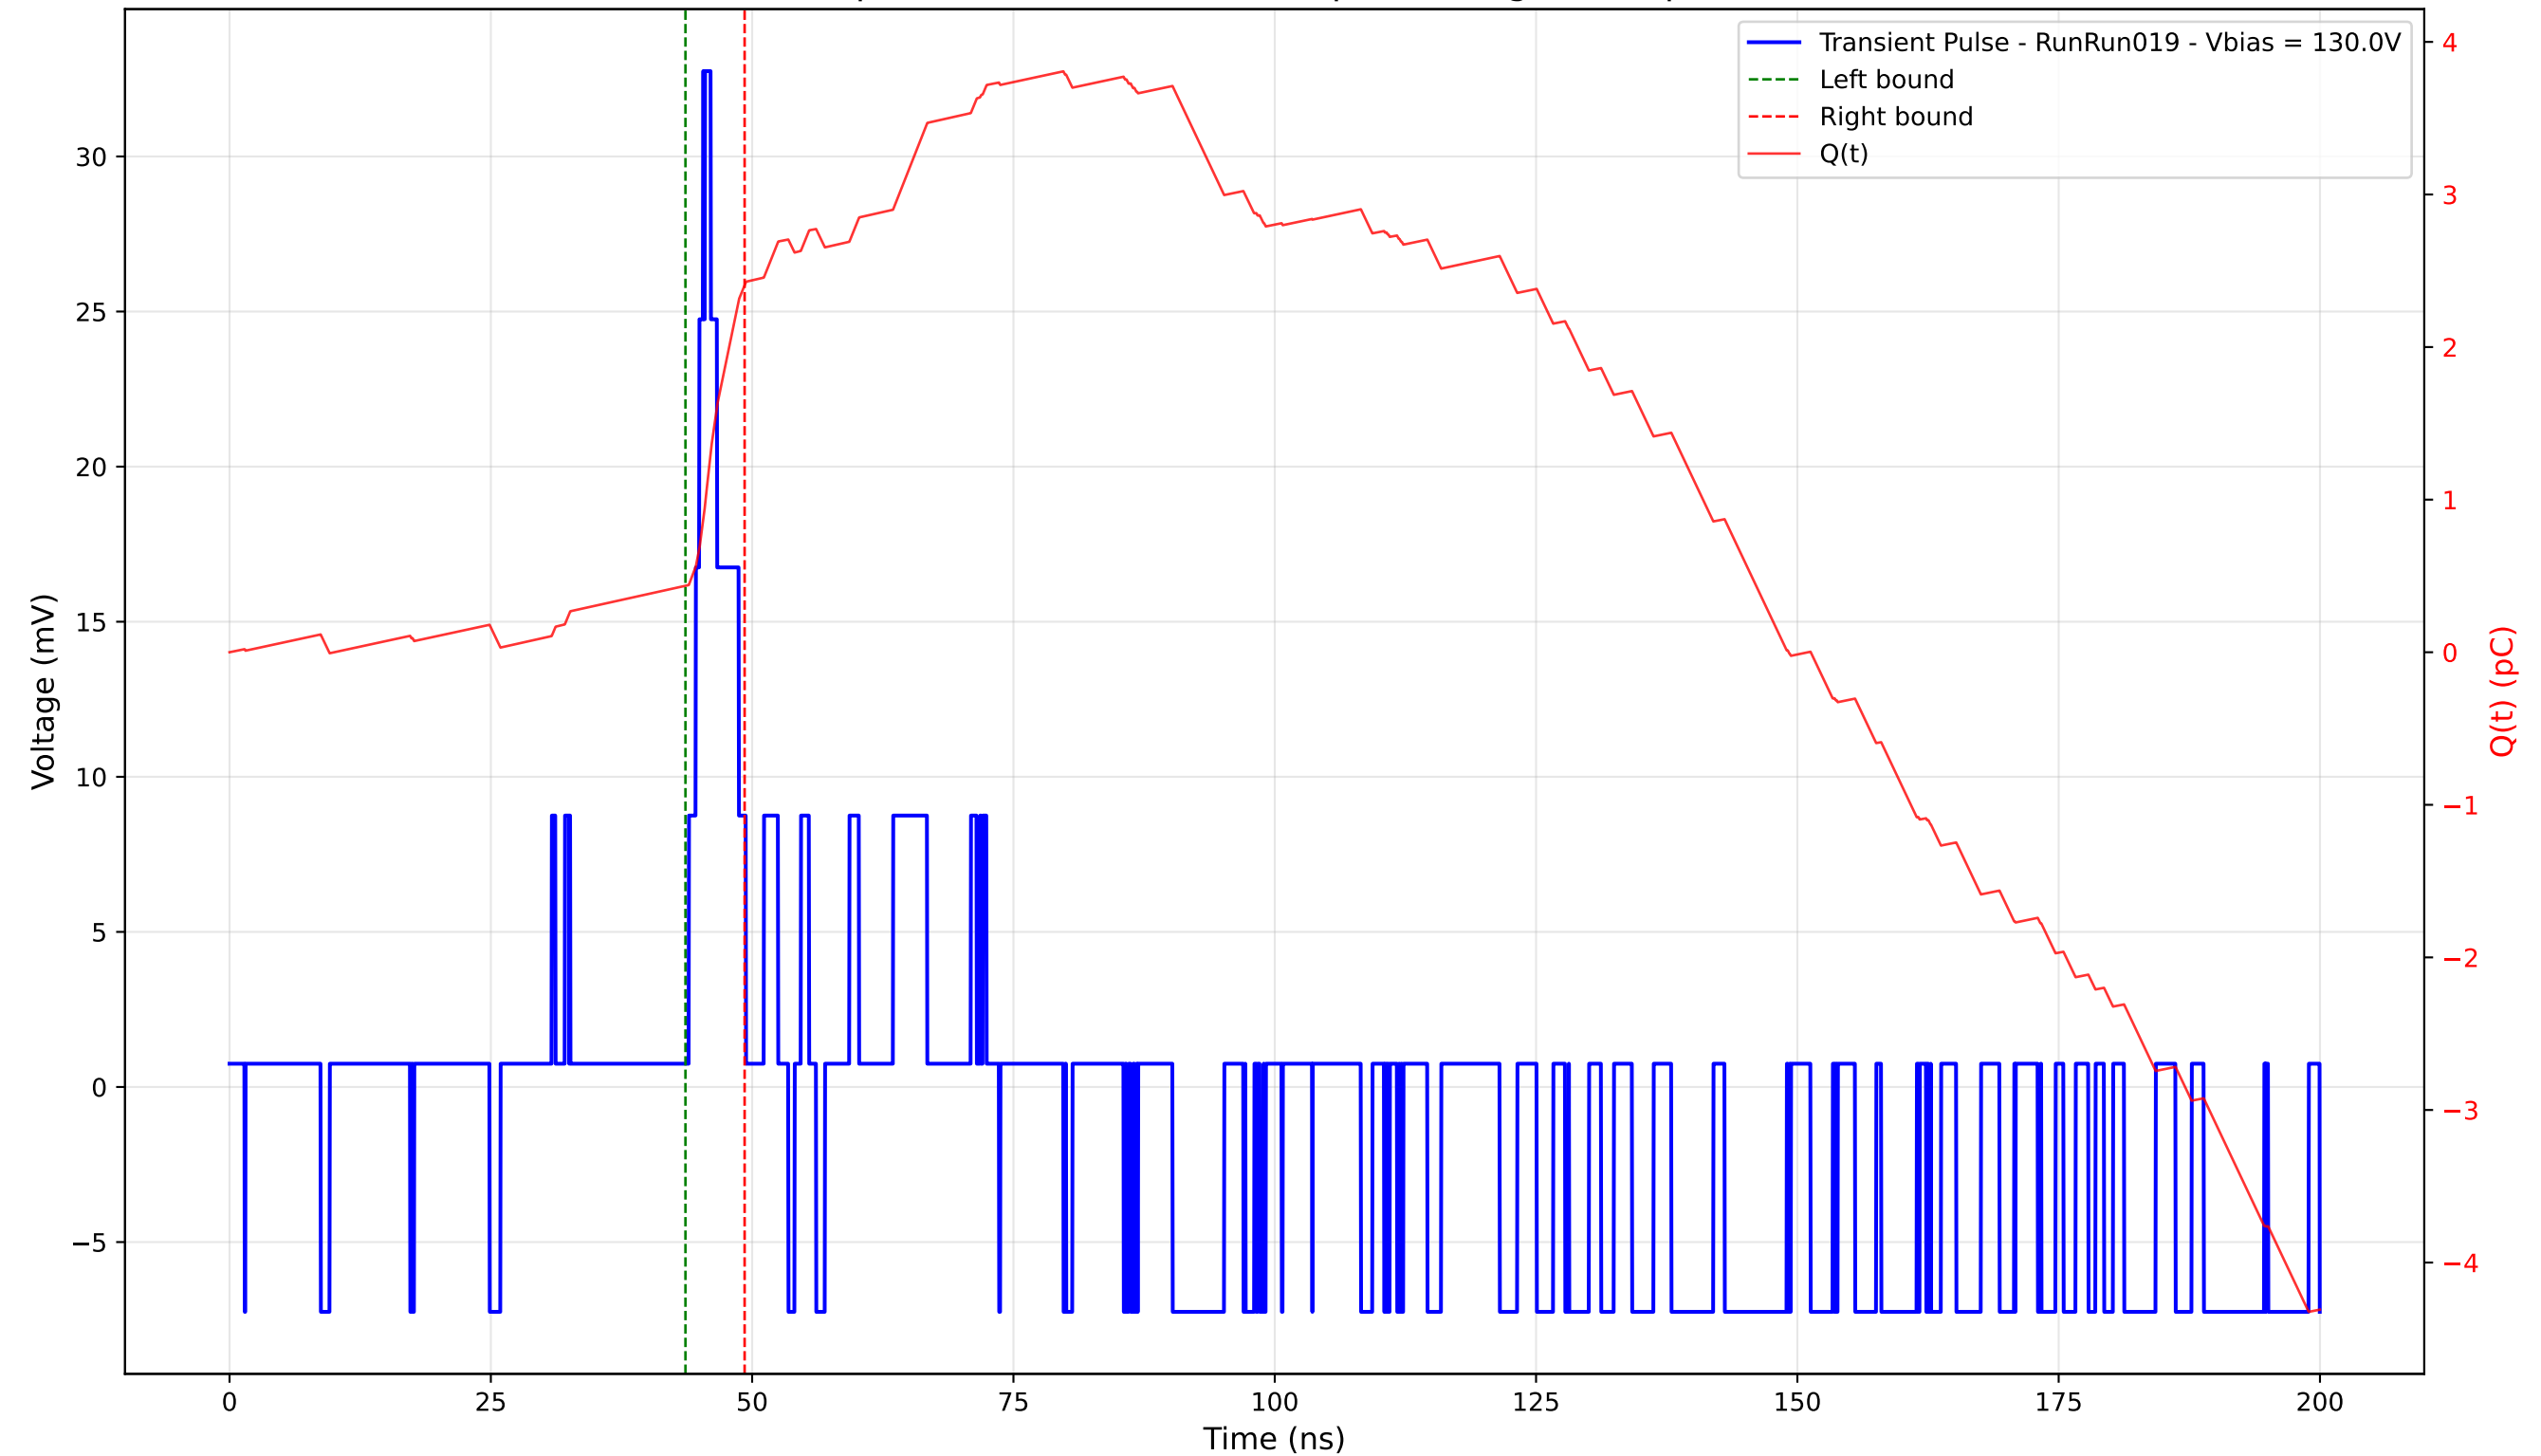

Transient Pulse - Sample: 4003 - Position: 415.0 μm - Charge: 1.10 pC - Rise Time: 0.74 ns

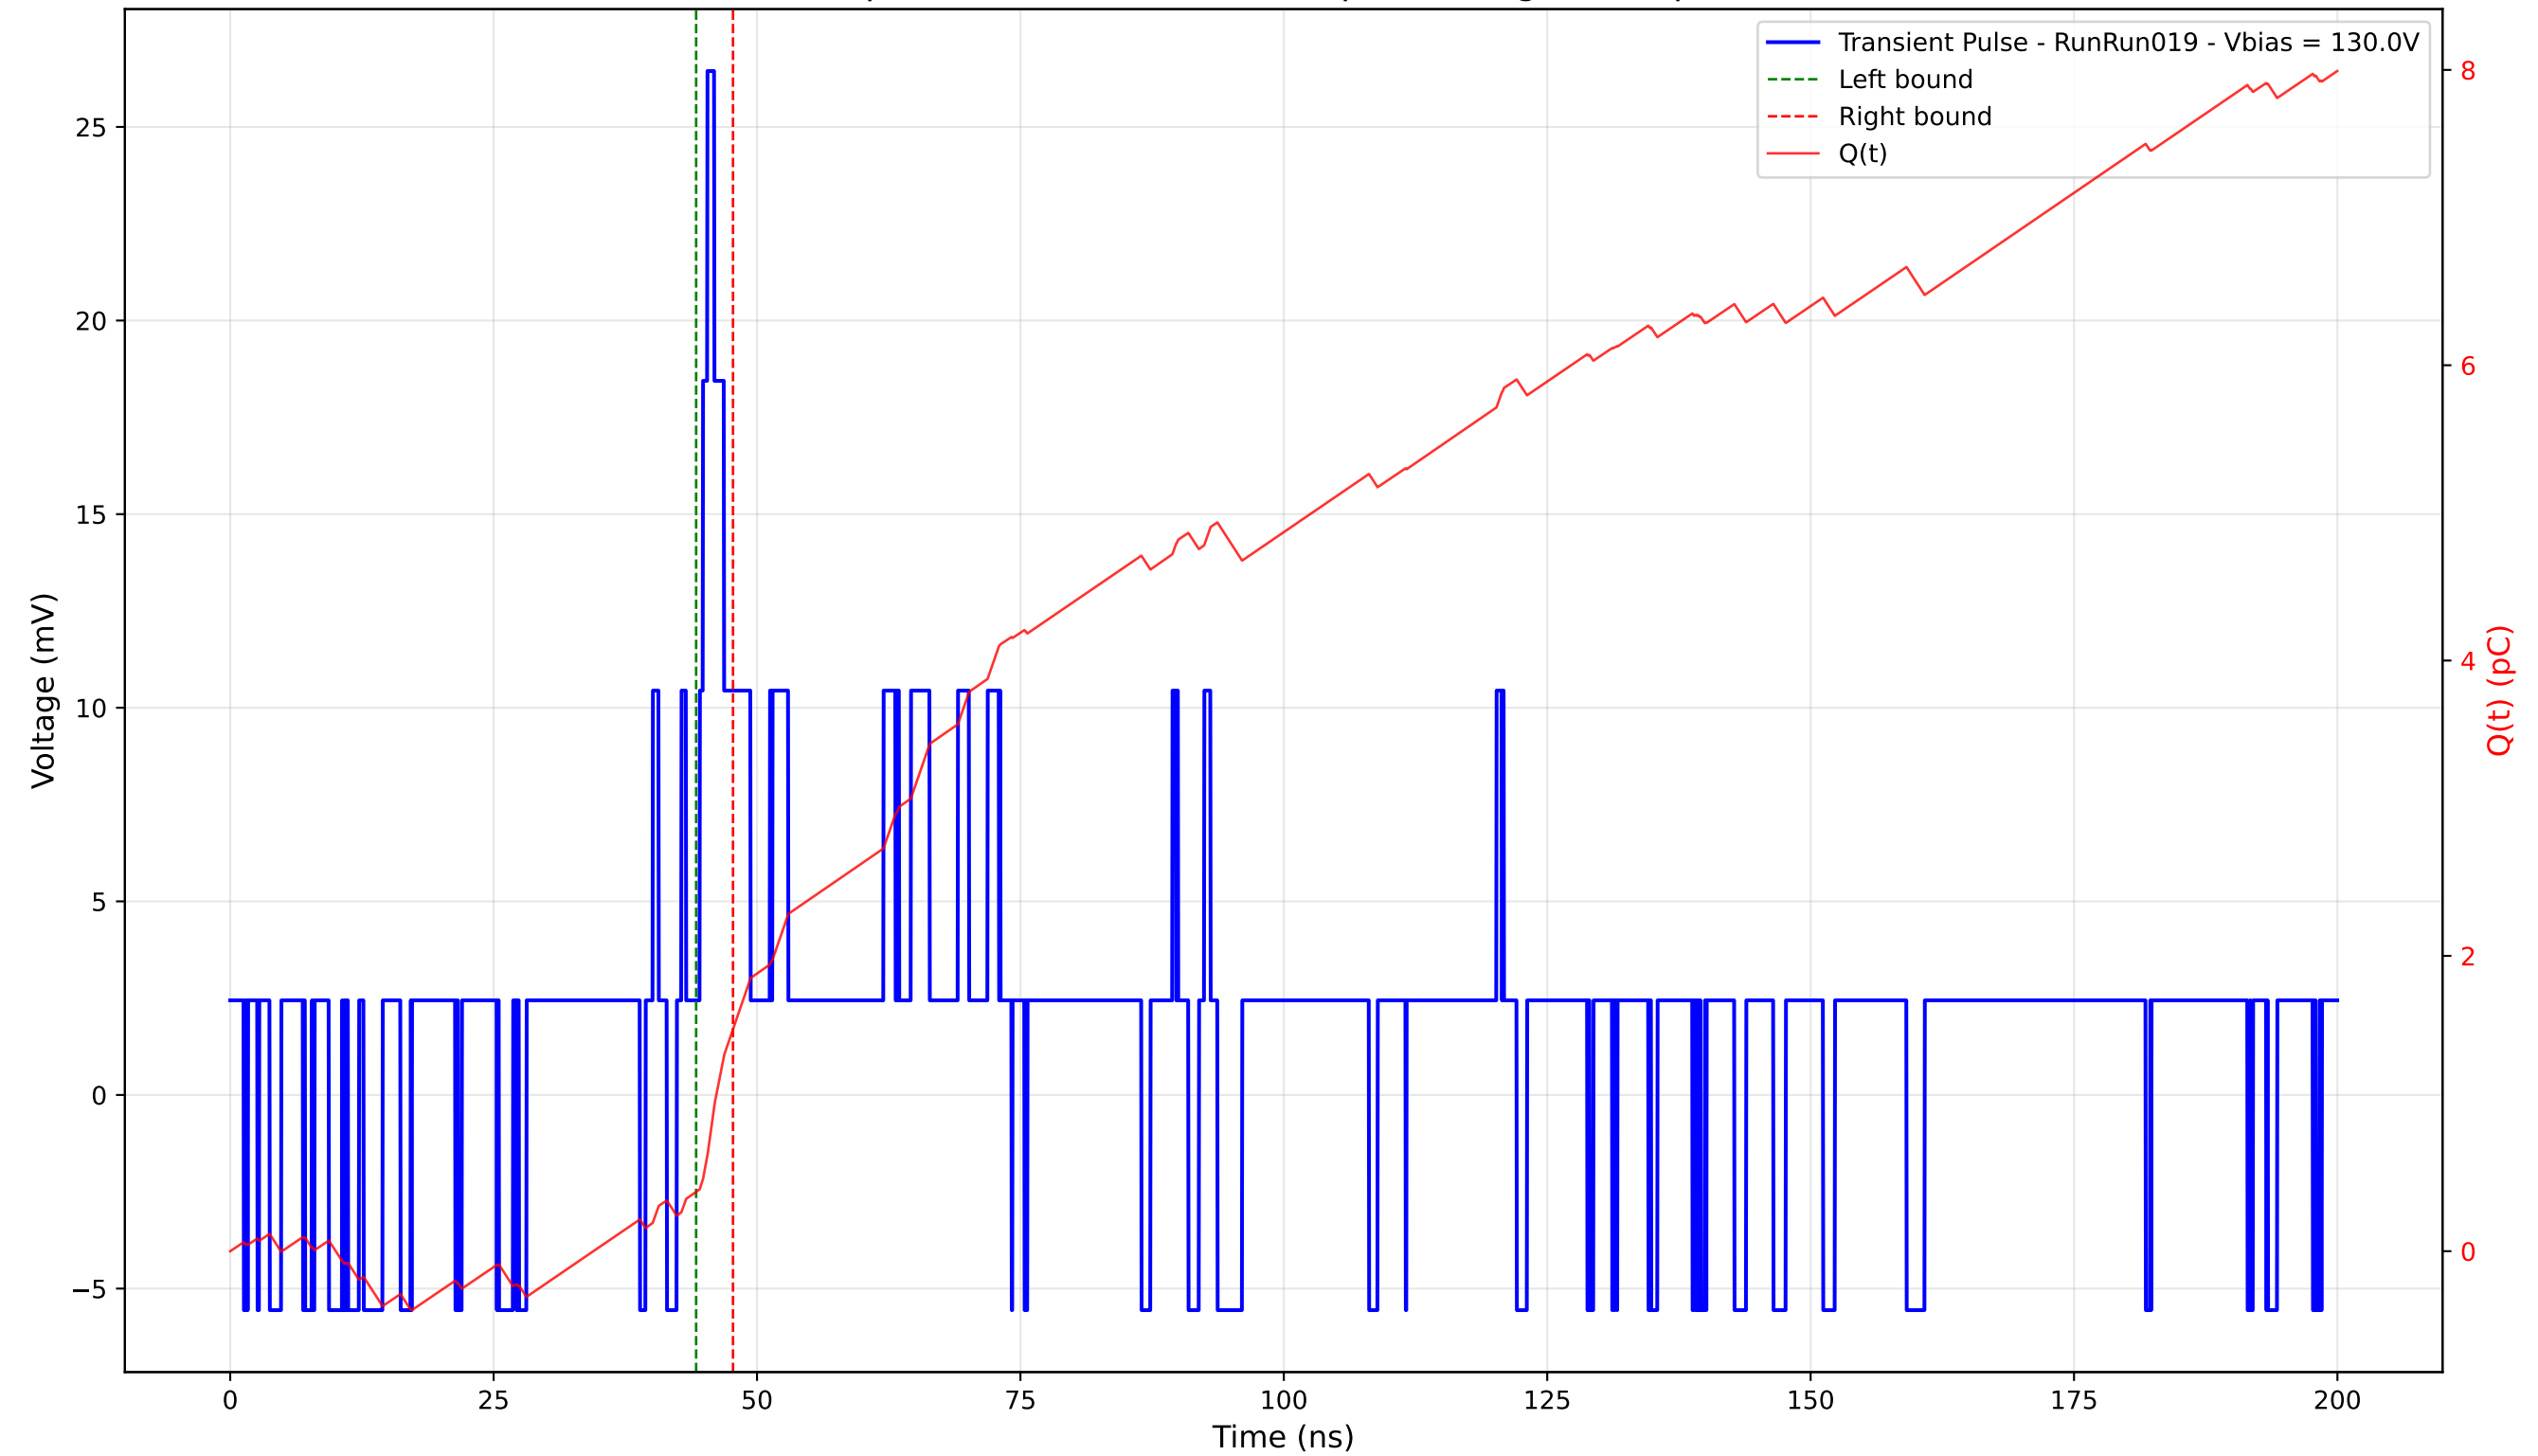

Transient Pulse - Sample: 4003 - Position: 420.0 μm - Charge: 2.98 pC - Rise Time: 0.00 ns (N/A)

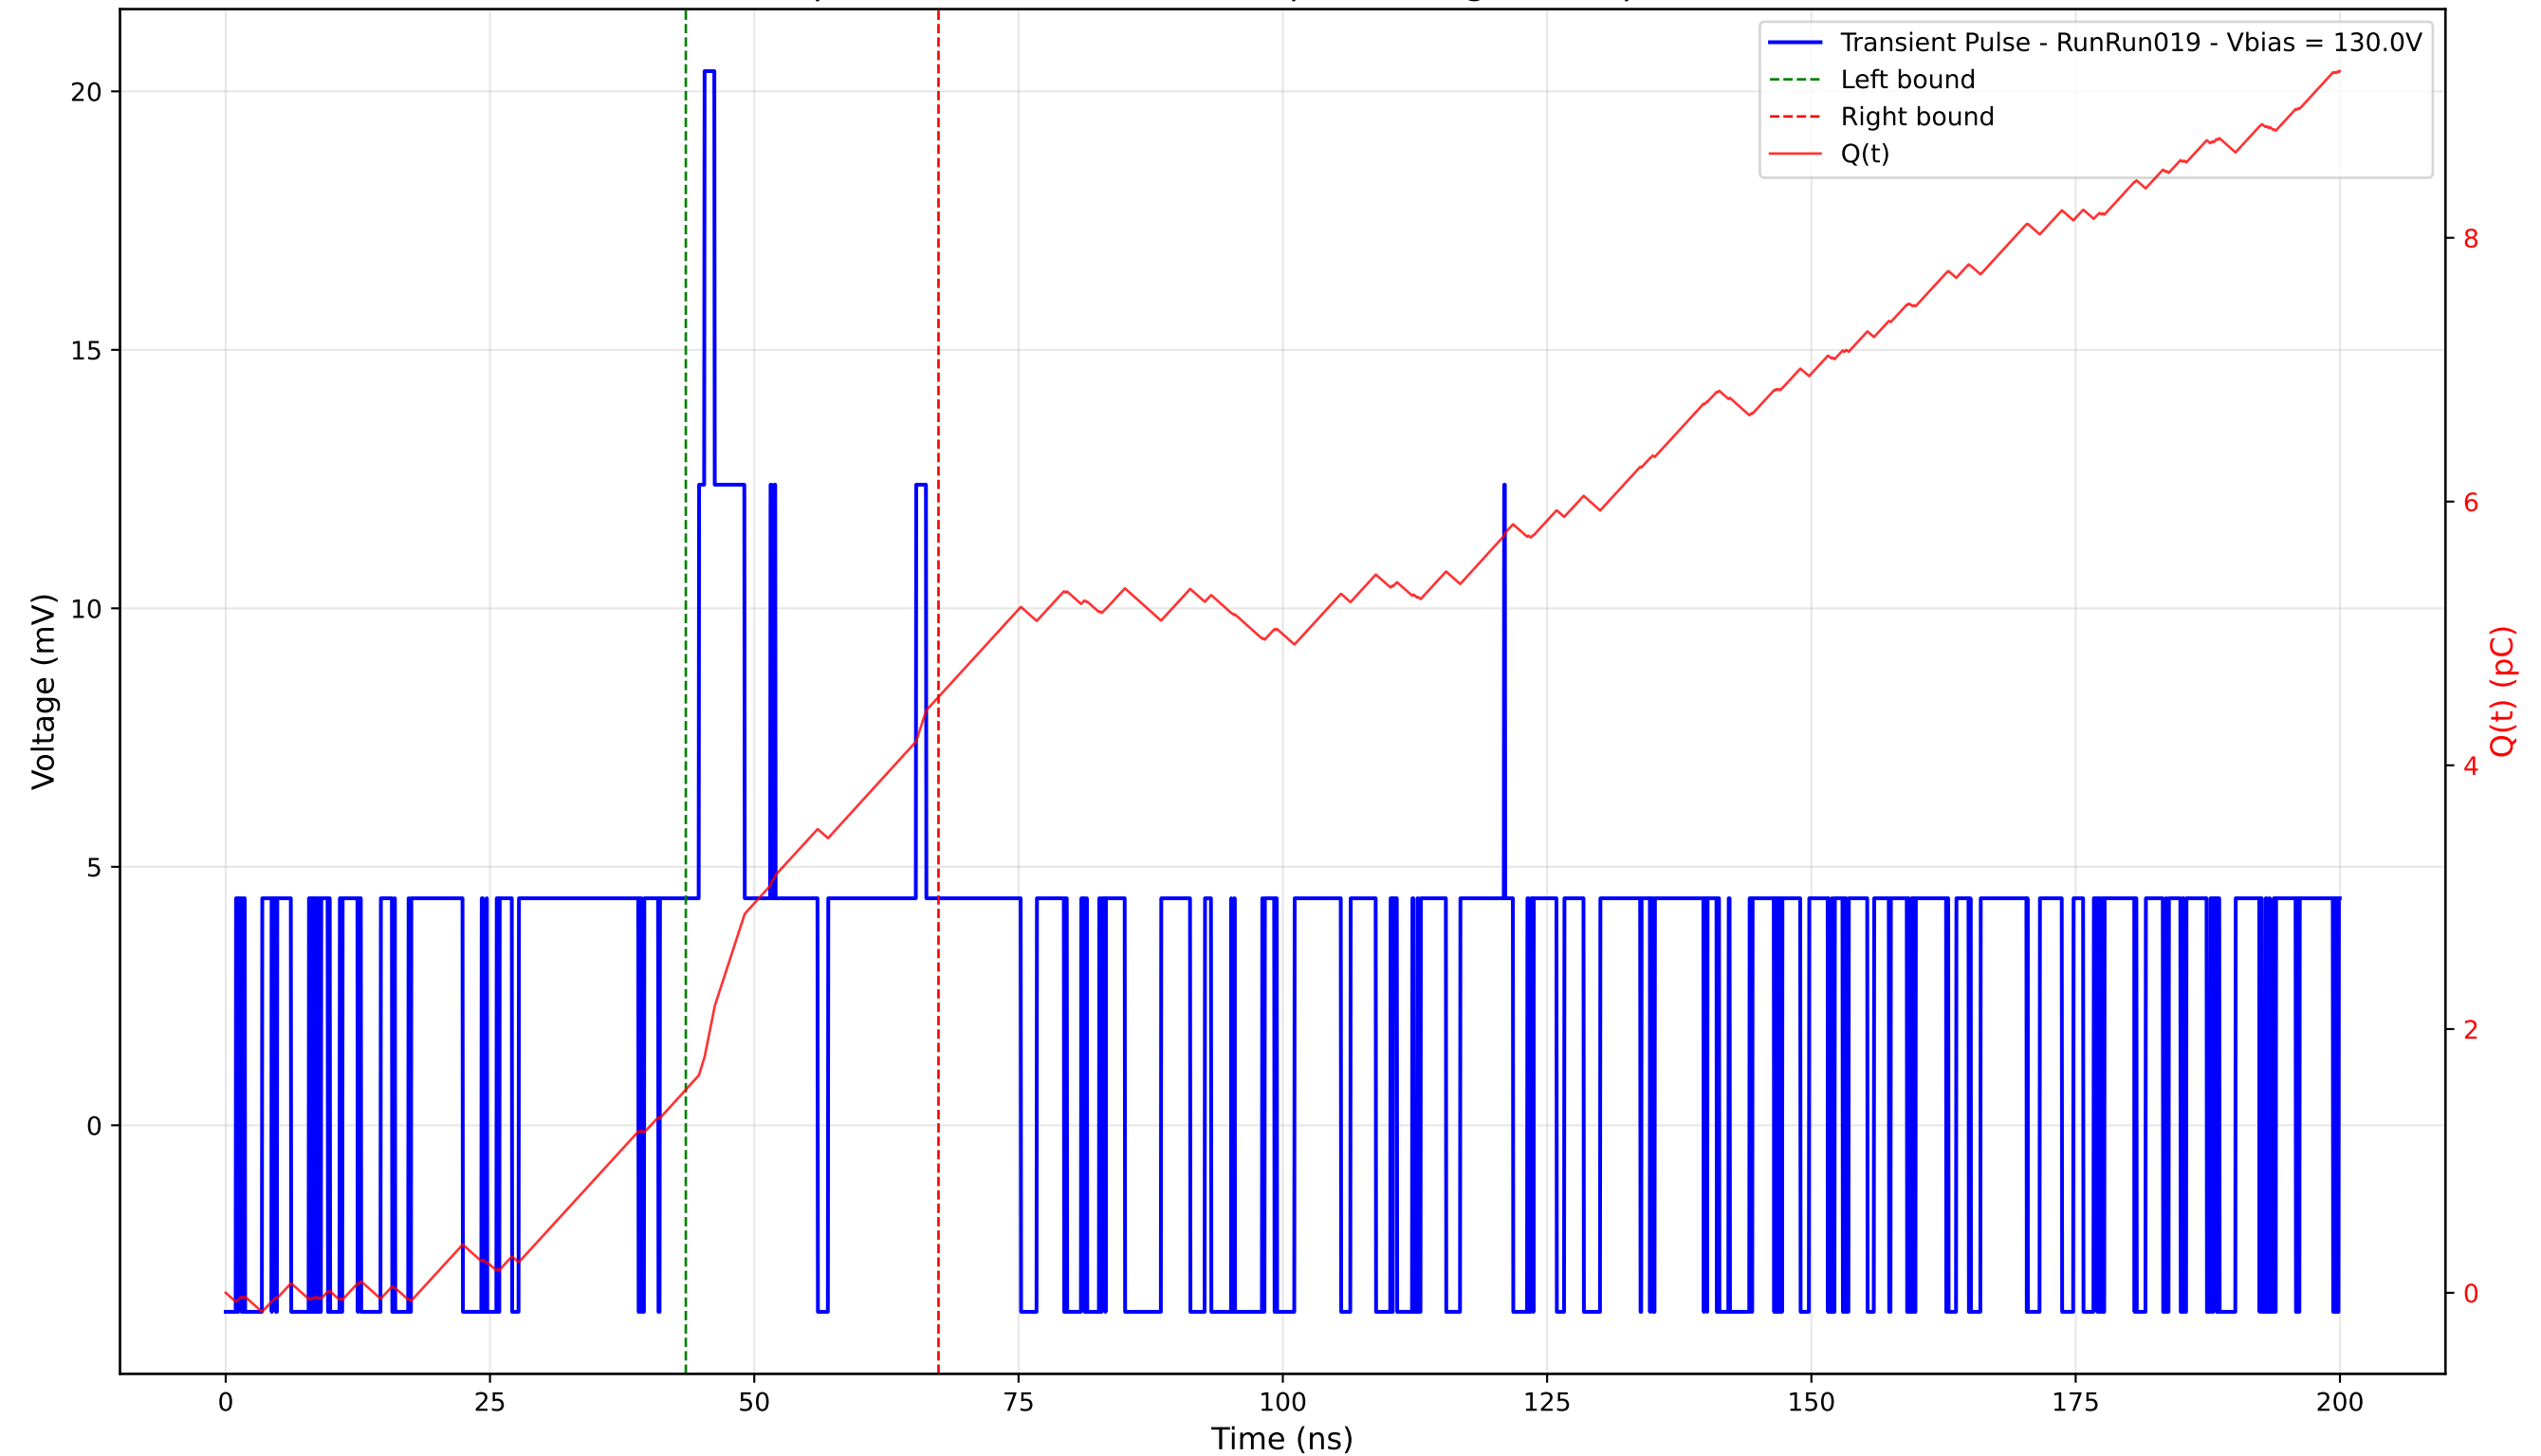

Transient Pulse - Sample: 4003 - Position: 425.0 μm - Charge: 1.95 pC - Rise Time: 0.92 ns

