

INSTRUMENT IDENTIFICATION LETTERS

FIRST- LETTERS	INITIATING OR MEASURED VARIABLE	PRIMARY ELEMENT	TRANSMITTERS	WELL OR PROBE	READOUT DEVICES		CONTROLLERS		CONTROL VALVES	SWITCH	ALARM	VIEWING DEVICE GLASS	SAFETY DEVICE	SOLENOID. RELAYS. COMPUTING DEVICES
					INDICATING	RECORDING	DCS CONTROLLER	LOCAL CONTROLLER						
A	ANALYSIS	AE	AT		AI	AR	AC	AIC		AS	AA			AY
B	BURNER FLAME	BE								BS	BA	BG		
F	FLOW RATE	FE	FT		FI	FR	FC	FIC	FV	FS	FA	FG		FY
H	HAND						HC	HIC	HV	HS				HY
L	LEVEL		LT		LI	LR	LC	LIC	LV	LS	LA	LG		LY
P	PRESSURE/VACUUM		PT		PI	PR	PC	PIC	PV	PS	PA	PG	PSV	PY
PD	PRESSURE DIFFERENTIAL		PDT		PDI		PDC					PDG		PDY
T	TEMPERATURE	TE	TT	TW		TR	TC	TIC	TV	TS	TA	TG		TY
V	VIBRATION									VS	VA			
Z	POSITION/DIMENSION				ZI					ZS				
	OTHER	_E	_T	_W	_I	_R	_C	_IC	_V	_S	_A	_G		_Y

* ADD SUFFIX LETTERS H. L. HH. OR LL TO SWITCHES AND ALARMS TO INDICATE HIGH. LOW. HIGH HIGH. OR LOW LOW.

PREFIX LETTERS
FOR OTHER VARIABLES

C	CONDUCTIVITY
D	DENSITY
E	VOLTAGE
FF	FLOW RATIO
I	CURRENT/ELECTRIC CURRENT
J	POWER
K	TIME
M	MOISTURE/HUMIDITY
Q	QUANTITY OR EVENT
R	RADIOACTIVITY
S	SPEED OR FREQUENCY
W	WEIGHT/FORCE
X	RUNNING


OTHER ABBREVIATIONS

B.L.	BATTERY LIMIT
CC	CHEMICAL CONNECTION
C.W.	COOLING WATER
EBD	EMERGENCY BLOWDOWN
ESD	EMERGENCY SHUTDOWN
HH	HANDHOLE
H ₂	HYDROGEN ANALYZER
H ₂ S	HYDROGEN SULFIDE ANALYZER
IA	AIR SUPPLY
JV	JACKET VALVE
MH	MANHOLE
NNF	NORMALLY NO FLOW
O ₂	OXYGEN ANALYZER
P	POINT (TEST CONN.)
P _H	P _H METER
PB	PUSH BUTTON SWITCH
RO	RESTRICTION ORIFICE
RTD	RESISTANCE TEMP ELEMENT
S/D	SHUTDOWN
SI	SPEED INDICATOR
SO	STEAM OUT
SP	SET POINT
SR	SPLIT RANGE
UA	COMMON PREALARM
UC	UTILITY CONNECTION
VB	VACUUM BREAKER
VISC.	VISCOSITY
XA	EQUIPMENT S/D ALARM OR MALFUNCTION
XI	RUNNING STATUS
XIC	SPEED CONTROL
PA	PURGE FAILURE

RELAY FUNCTION
DESIGNATIONS


TYPES	
	= ADD
	= SUBTRACT
	= BIAS
	= DIVIDE
	= MULTIPLY
	= EXTRACT SQUARE ROOT
	= HIGH SELECT
	= LOW SELECT
	= CONSTANT FACTOR
	= BOOSTER
REV.	= REVERSE
	= PULSE TO CURRENT
	= CURRENT TO PULSE
	= CURRENT TO PNEUMATIC
	= PNEUMATIC TO CURRENT
	= VOLTAGE TO CURRENT
	FLUSHING (O - OIL) (W - WATER)
	PURGE (W - WATER) (H ₂ - HYDROGEN) (O - OIL)
	RESET FOR LATCH TYPE ACTUATOR
	INTERLOCK IF ALL INPUTS EXIST
	INTERLOCK IF ANY ONE OR MORE INPUTS EXIST
	INTERLOCK LOGIC

INSTRUMENT
NOMENCLATURE

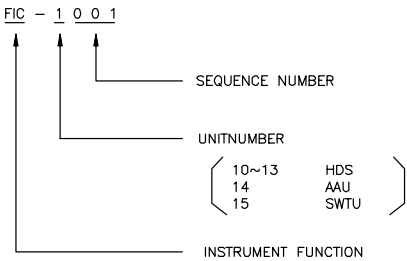

INSTRUMENT IDENTIFICATION SYMBOLS

	LOCALLY MOUNTED INSTRUMENT
	BOARD MOUNTED INSTRUMENT
	INSTRUMENT FURNISHED WITH PROCESS EQUIPMENT
	INSTRUMENT MOUNTED BEHIND BOARD OR ON RACK
	LOCAL PANEL MOUNTED INSTRUMENT (CP - COMPRESSOR PANEL. HP - HEATER PANEL) (LP - LOCAL PANEL IN LOCAL CONTROL ROOM)
	DISTRIBUTED CONTROL SYSTEM. BLIND CONTROLLER/COMPUTATION/SIGNAL. CONDITIONING OR SHARED DISPLAY INSTALLED IN FIELD. NOT NORMALLY ACCESSIBLE TO OPERATOR
	DISTRIBUTED CONTROL SYSTEM. INDICATOR/CONTROLLER/RECORDER OR ALARM POINT. NORMALLY ACCESSIBLE TO OPERATOR.
	MALFUNCTION ALARM
	MOTOR OPERATED VALVE SWITCH ON DCS WITH CLOSE-STOP-OPEN FUNCTION
	MOTOR OPERATED VALVE SWITCH ON BOARD WITH CLOSE-STOP-OPEN FUNCTION
	DISTRIBUTED CONTROL SYSTEM WITH TREND MEMORY CAPABILITY
	DISTRIBUTED CONTROL SYSTEM WITH SOFT-WIRED HIGH (LOW) ALARM FUNCTION
	DISTRIBUTED CONTROL SYSTEM WITH SOFT-WIRED HIGH HIGH (LOW LOW) ALARM FUNCTION
	HEAT TRACED INSTRUMENT
	IN-LINE TYPE FLOW INSTRUMENT PDM (DISPLACEMENT METER) MAG (MAGNETIC FLOWMETER) INTEG.-(INTEGRAL ORIFICE) ULTRA SONIC
	PILOT LIGHT (R-RED. G-GREEN. A-AMBER)
	PROCESS COMPUTER NOT NORMALLY ACCESSIBLE TO OPERATOR
	PROCESS COMPUTER NORMALLY ACCESSIBLE TO OPERATOR
	PACKAGED PROGRAMMABLE LOGIC CONTROLLER OR DIGITAL LOGIC CONTROL INTEGRAL TO THE DISTRIBUTED CONTROL SYSTEM. NOT NORMALLY ACCESSIBLE TO OPERATOR
	PACKAGED PROGRAMMABLE LOGIC CONTROLLER OR DIGITAL LOGIC CONTROL INTEGRAL TO THE DISTRIBUTED CONTROL SYSTEM. NORMALLY ACCESSIBLE TO OPERATOR
	ELECTRIC SWITCH CHANGE-OVER
	INSTRUMENT WITH TWO FUNCTIONS
	INSTRUMENT SUPPLY OR CONNECTION TO PROCESS
	INSTRUMENT LINE. PNEUMATIC SIGNAL
	INSTRUMENT LINE. ELECTRICAL SIGNAL
	INSTRUMENT LINE. CAPILLARY TUBE
	INSTRUMENT LINE. HYDRAULIC SIGNAL
	INSTRUMENT LINE. ELECTRIC TRACING
	INSTRUMENT LINE. SOFTWARE OR COMMUNICATION LINK
	INSTRUMENT LINERADIOACTIVE. SONIC OR LIGHT SIGNAL
	CONTROL VALVE
	CONTROL VALVE WITH MANUAL OPERATION
	CONTROL DAMPER
	HAND OPERATED CONTROL VALVE
	MAGNETIC FLOW METER

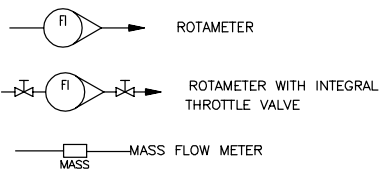

	PRESSURE CONTROL VALVE, EXTERNAL TAP
	PRESSURE CONTROL VALVE, SELF CONTAINED
	FLOAT OPERATED VALVE
	AIR CYLINDER OPERATED VALVE
	ELECTRO HYDRAULIC OPERATED VALVE
	ELECTRO MOTOR OPERATED VALVE
	SOLENOID VALVE
	THREE-WAY SOLENOID VALVE LATCH TYPE WITH MANUAL RESET. SHOWING DEENERGIZED POSITION
	THREE-WAY SOLENOID VALVE, SHOWING DEENERGIZED POSITION
	FOUR WAY SOLENOID VALVE
	DOUBLE DIAPHRAGM CONTROL VALVE
	DIAPHRAGM OPERATED BUTTERFLY VALVE
	DIAPHRAGM OPERATED BALL VALVE OR ECCNTRIC DISC VALVE
	DIAPHRAGM OPERATED ANGLE VALVE
	RELIEF VALVE
	PRESSURE OR VACUUM RELIEF VALVE
	RUPTURE DISC FOR PRESSURE RELIEF
	RUPTURE DISC FOR VACUUM RELIEF
	DIAPHRAGM SEAL
	CHEMICAL SEAL
	ORIFICE PLATE
	VORTEX FLOW ELEMENT
	POSITIVE DISPLACEMENT METER
	TURBINE OR PROPELLER TYPE FLOW ELEMENT
	VENTURI
	ANNUBAR
	FLOW NOZZLE

Att-4