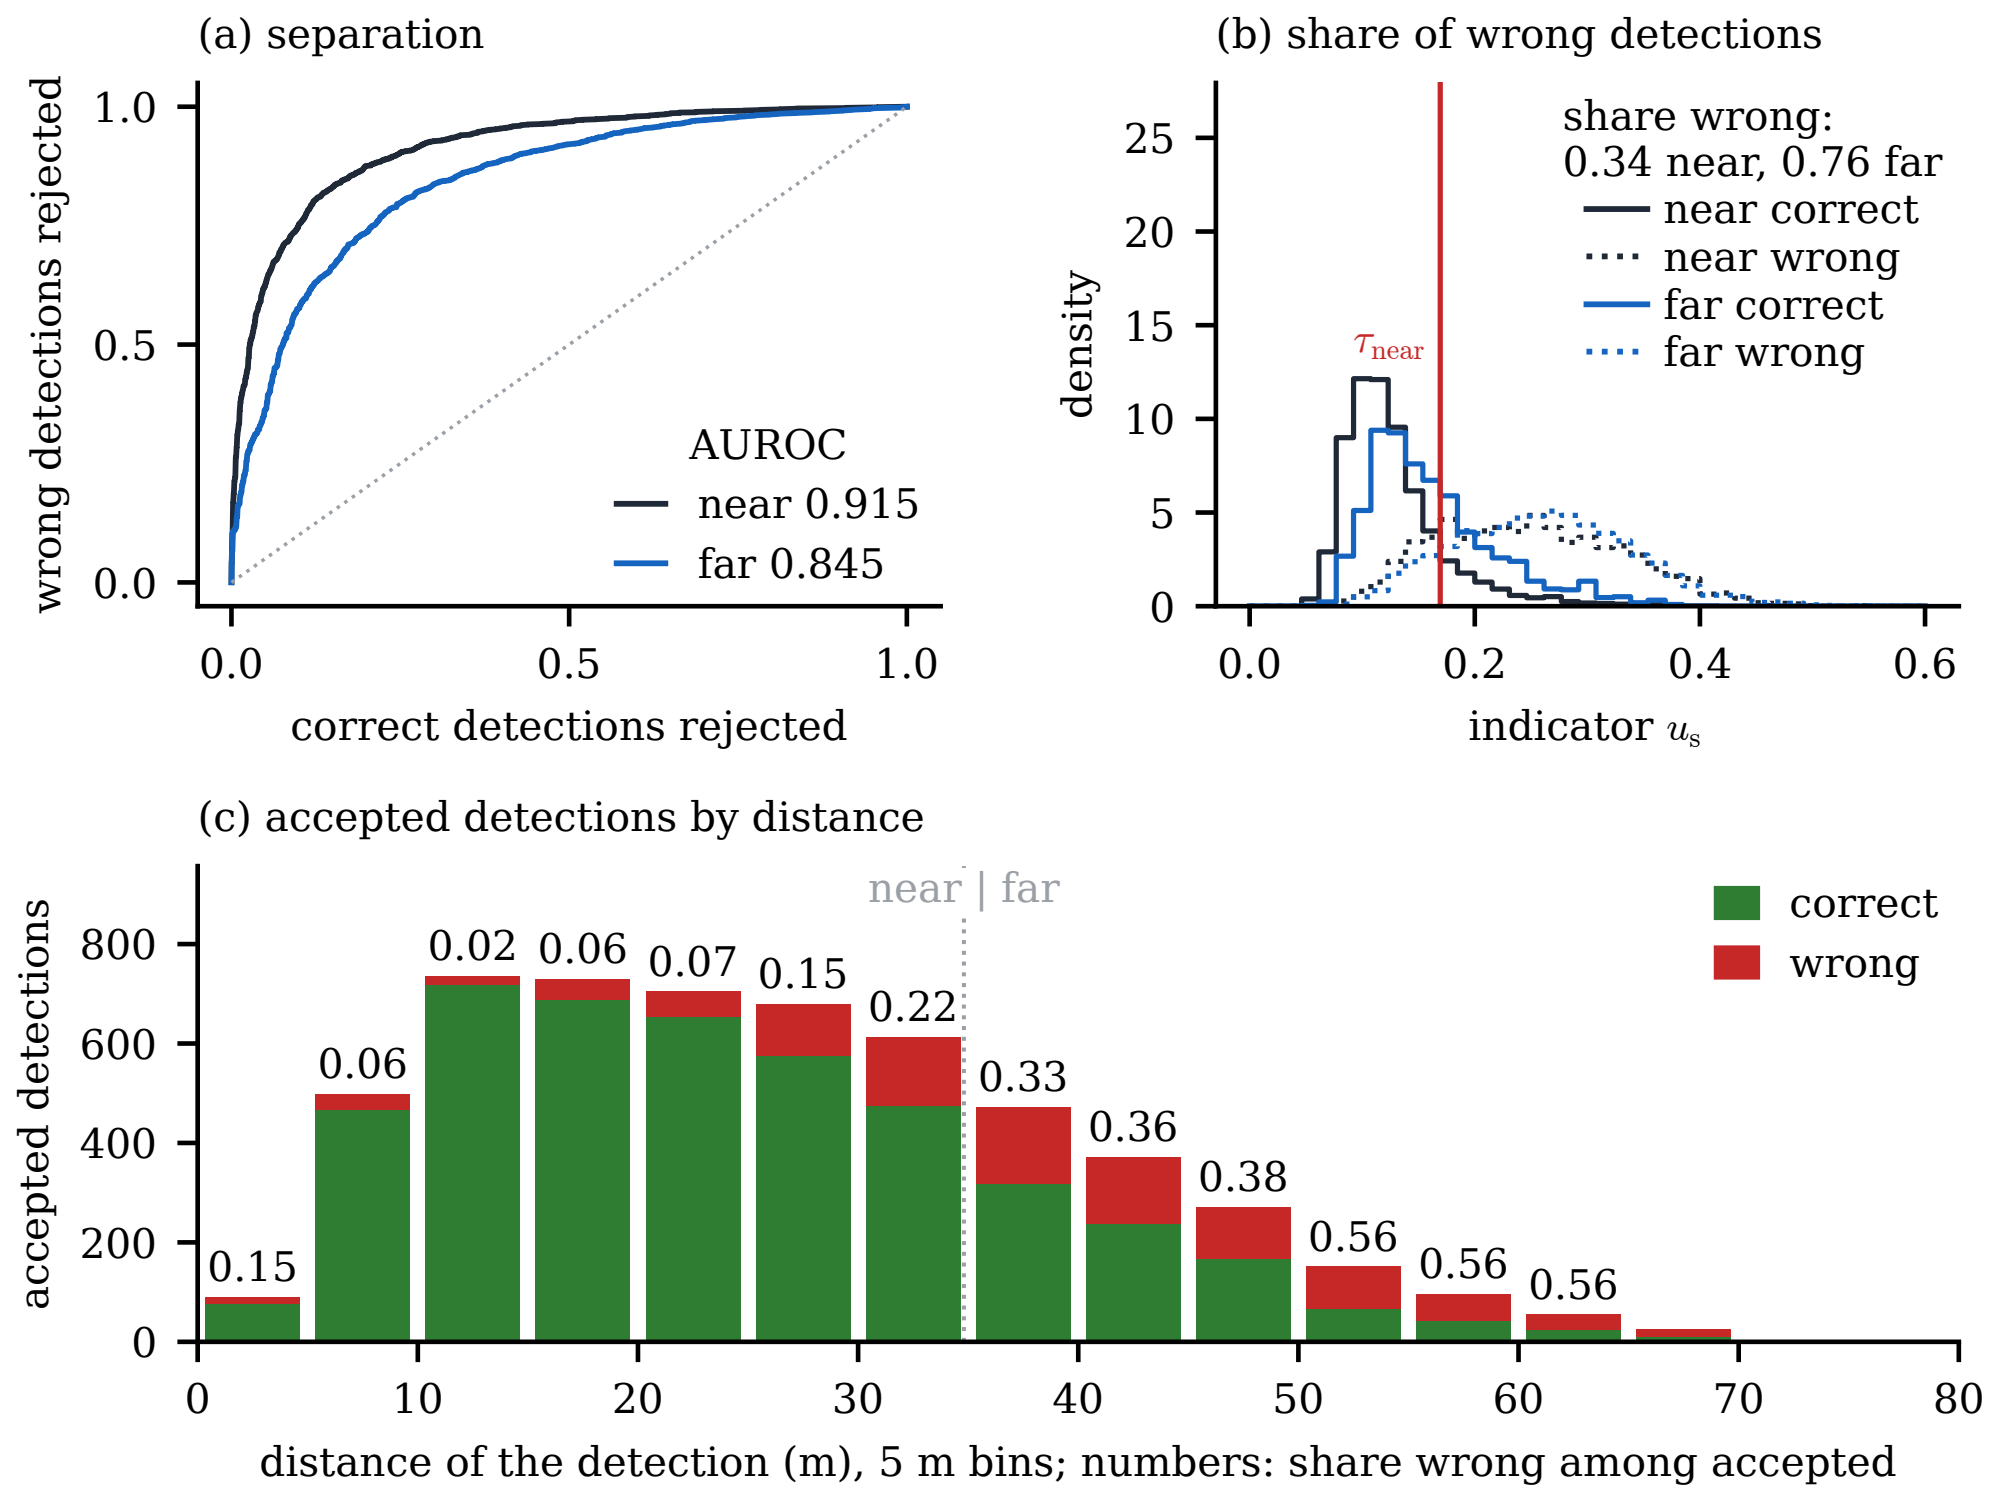
(a) separation
wrong detections rejected
correct detections rejected
AUROC
near 0.915
far 0.845
(b) share of wrong detections
density
indicator $u_s$
$\tau_{near}$
share wrong:
0.34 near, 0.76 far
near correct
near wrong
far correct
far wrong
(c) accepted detections by distance
accepted detections
near | far
correct
wrong
0.15
0.06
0.02
0.06
0.07
0.15
0.22
0.33
0.36
0.38
0.56
0.56
0.56
distance of the detection (m), 5 m bins; numbers: share wrong among accepted