AZUM007



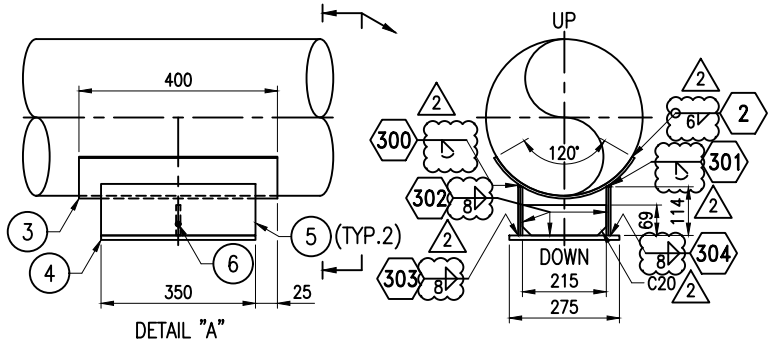

DETAIL "A"
LOOKING EAST

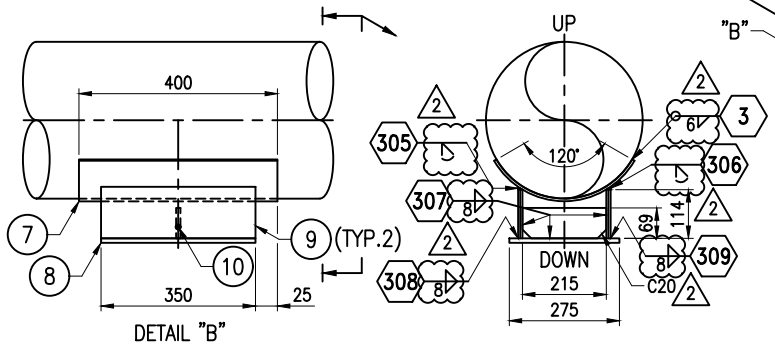

DETAIL "B"
LOOKING EAST

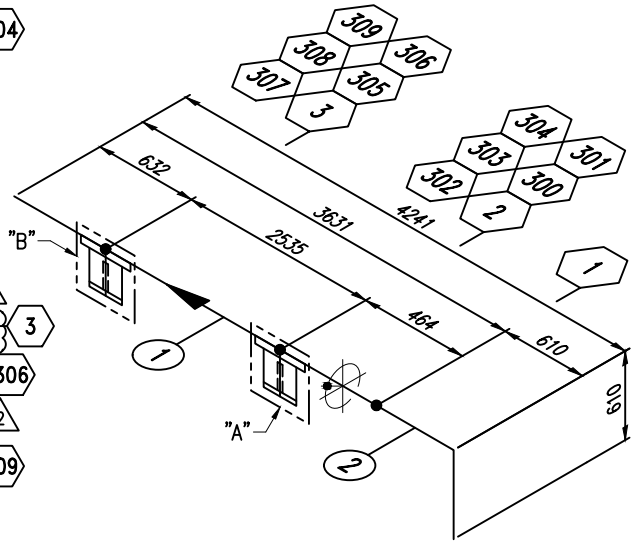

HEAT NO.	NO.	ITEM	MATERIAL	SIZE 1	SIZE 2	THICKNESS 1	THICKNESS 2	TYPE	Q'TY (MM,EA)	WEIGHT (KG) UNIT(M,EA)	WEIGHT (KG) TOTAL	REMARK
	1	PIPE-WELDED	API 5L-B PSL.1	16"		S/40			3631	123.3	447.7	-
	2	90D LR ELBOW	A234-WPB	16"		S/40		BW	1	118.0	118.0	-
	3	PAD PLATE(1-Ø10)	A36	431	400	PL6			1	8.1	8.1	00EKG06BR002_UAY00Y-A1-BQ001ST
	4	BASE PLATE	A36	275	350	PL10			1	7.6	7.6	00EKG06BR002_UAY00Y-A1-BQ001ST
	5	PLATE(SPECIAL)	A36	114	350	PL10			2	3.1	6.2	00EKG06BR002_UAY00Y-A1-BQ001ST
	6	PLATE(SPECIAL)	A36	69	215	PL10			1	1.2	1.2	00EKG06BR002_UAY00Y-A1-BQ001ST
	7	PAD PLATE(1-Ø10)	A36	431	400	PL6			1	8.1	8.1	00EKG06BR002_UAY00Y-A1-BQ002ST
	8	BASE PLATE	A36	275	350	PL10			1	7.6	7.6	00EKG06BR002_UAY00Y-A1-BQ002ST
	9	PLATE(SPECIAL)	A36	114	350	PL10			2	3.1	6.2	00EKG06BR002_UAY00Y-A1-BQ002ST
	10	PLATE(SPECIAL)	A36	69	215	PL10			1	1.2	1.2	00EKG06BR002_UAY00Y-A1-BQ002ST
									TOTAL W.T (KG)	611.9	END TO END (MM)	4285

PREHEAT CHECK(Min. °C)

Dimensional & Visual Inspection
☐ Accept ☐ Reject

NOTES
1. SEE FABRICATION STANDARD DOCUMENT NO.AZU-FAB-STD-001 FOR SPOOL FABRICATION.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
3. ALL BUTTWELDINGS AND O-LET WELDINGS ARE FULL PENETRATION WELD.
4. FFW=FIELD FITTED WELD
5. ⊕ : ORIENTATION OF LONGITUDINAL WELD SEAM FOR WELDED PIPE

REV.	DATE	DESCRIPTION	PREPARED	CHECKED	REVIEWED	APPROVED
2	2025.01.13	REVISED AS PER MARKED	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO
1	2024.12.24	REVISED AS PER MARKED	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO
0	2024.12.10	FIRST ISSUE	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO

APPLICABLE CODE		ASME B31.1(2022)	CODE JURISDICTION	NBEP
DESIGN	PRESS.	44.13 bar (g)	INSULATION(Y/N)	Y
	TEMP.	60 °C	END BEVEL TYPE	A
COATING		26-21-00-PRO-MM-0802-001	STAMP(Y/N)	N
HYDROSTATIC TEST(Y/N)		N	TEST PRESSURE	- bar (g)

WELD TABLE					NDE TABLE							PWHT (Y/N)	WPS NO.	REMARK
JOINT NO.	MAT'L	SIZE	THK.	WELD TYPE	RT	UT	MT	PT	VT	HT	PMI			
1	C/S	16"	12.70T	BW	100%	-	-	-	100%	-	-	N	SH-0101-GF-18	-
2	C/S	OD529.0	6.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
300	C/S	OD111.4	10.00T	GW	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
301	C/S	OD111.4	10.00T	GW	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
302	C/S	OD224.1	8.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
303	C/S	OD222.8	8.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
304	C/S	OD222.8	8.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-

WELD TABLE					NDE TABLE							PWHT (Y/N)	WPS NO.	REMARK
JOINT NO.	MAT'L	SIZE	THK.	WELD TYPE	RT	UT	MT	PT	VT	HT	PMI			
3	C/S	OD529.0	6.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
305	C/S	OD111.4	10.00T	GW	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
306	C/S	OD111.4	10.00T	GW	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
307	C/S	OD224.1	8.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
308	C/S	OD222.8	8.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
309	C/S	OD222.8	8.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-

EXPLANATION FOR WELD TABLE AND NDE TABLE
RT=RADIOGRAPHIC EXAMINATION, UT=ULTRASONIC EXAMINATION, MT=MAGNETIC PARTICLE EXAMINATION, PT=LIQUID PENETRATION EXAMINATION, VT=VISUAL EXAMINATION, HT=HARDNESS TESTING, PMI=POSITIVE MATERIAL IDENTIFICATION,**.*T: NOMINAL WALL THK., M**.*: MINIMUM WALL THK.
WELD TYPE: BW=BUTT WELD, O-LET= BRANCH WELD(WELDOLET, SOCKOLET, ...), SW=SOCKET WELD, GW=GROOVED(OR W/ FILLET) WELD, FIL=FILLET WELD, SEAL=SEAL WELD, TACK=TACK WELD, THRD=THREADED JOINT, HOLE= HOLE WITHOUT WELDING(RT HOLE, ...), - = NO MAIN WELDING

PARTS	A	MAT'L INSP.(M/K,C/T)	B	FIT-UP	C	WELDING	D	PWHT	E	NDE	F	FINAL INSP.
PD	H		H		H		H				H	
QC	H		H		H		H		H		H	
CUSTOMER												
RECORD NO.												

Project
UTE Azulão 950 MW

Customer
elecnor

Manufacturer
SEONGHWA

Title
PREFABRICATED PIPE SPOOL DRAWING
FUEL GAS SYSTEM

FAB. ISOMETRIC DRAWING NUMBER	00EKG06BR002_UAY00Y-A1	SCALE	NONE
		SHEET	1/1
SPOOL DRAWING NUMBER	00EKG06BR002_UAY00Y-A1_SP-001	SERIAL NUMBER	AZUM007

A4 (210 x 297mm/mm)