AZUM011

HEAT NO.	NO.	ITEM	MATERIAL	SIZE 1	SIZE 2	THICKNESS 1	THICKNESS 2	TYPE	Q'TY (MM,EA)	WEIGHT (KG) UNIT(M,EA)	WEIGHT (KG) TOTAL	REMARK
	1	PIPE-SMLS	API 5L-B PSL.1	10"		S/20			6000	41.8	250.8	-
	2	PIPE-SMLS	API 5L-B PSL.1	10"		S/20			6000	41.8	250.8	-
	3	PIPE-SMLS	API 5L-B PSL.1	10"		S/20			3977	41.8	166.2	-
	4	PIPE-SMLS	API 5L-B PSL.1	10"		S/20			2072	41.8	86.6	-
	5	90D LR ELBOW	A234-WPB	10"		S/20		BW	1	25.0	25.0	-
	6	PAD PLATE(1-Ø6)	A36	292	270	PL6			1	3.7	3.7	20GMA30BR002_UAY00Y-B1-BQ001ST
	7	PAD PLATE(1-Ø6)	A36	292	270	PL6			1	3.7	3.7	20GMA30BR002_UAY00Y-B1-BQ002ST
	8	PAD PLATE(1-Ø6)	A36	292	270	PL6			1	3.7	3.7	20GMA30BR002_UAY00Y-B1-BQ003ST
	9	PAD PLATE(1-Ø6)	A36	292	270	PL6			1	3.7	3.7	20GMA30BR002_UAY00Y-B1-BQ004ST
										TOTAL W.T (KG)	794.2	END TO END (MM) 16541

PREHEAT CHECK(Min. °C)

Dimensional & Visual Inspection

☐ Accept ☐ Reject

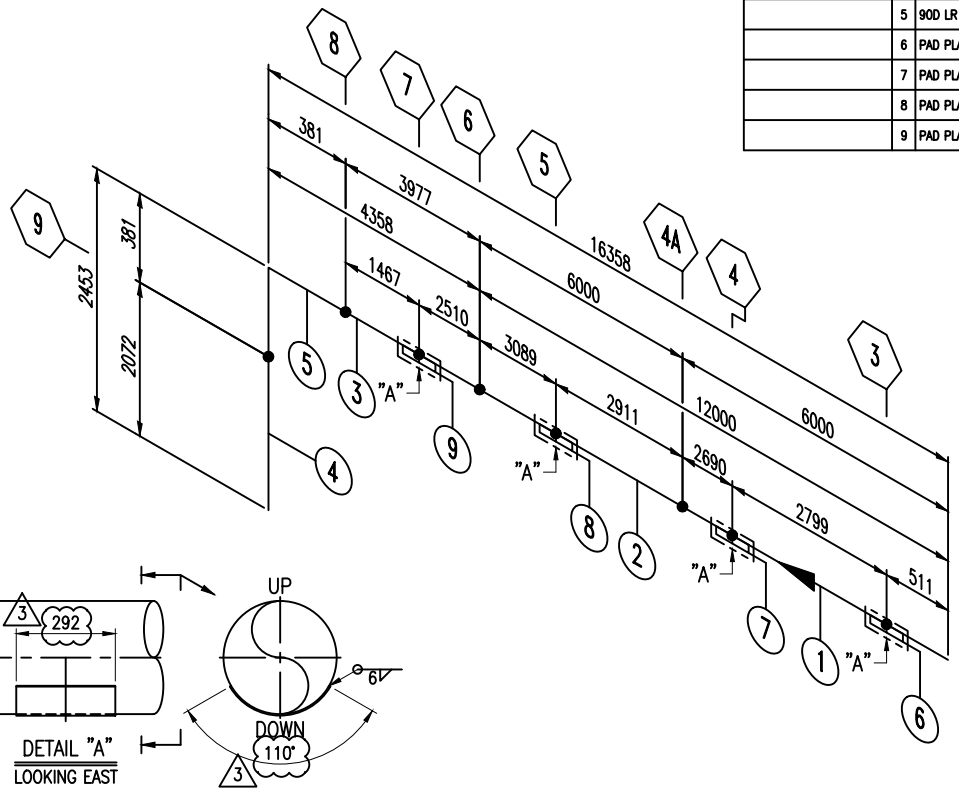

NOTES
1. SEE FABRICATION STANDARD DOCUMENT NO.AZU-FAB-STD-001 FOR SPOOL FABRICATION.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.
3. ALL BUTTWELDINGS AND O-LET WELDINGS ARE FULL PENETRATION WELD.
4. FFW=FIELD FITTED WELD
5. ⊕ : ORIENTATION OF LONGITUDINAL WELD SEAM FOR WELDED PIPE

REV.	DATE	DESCRIPTION	PREPARED	CHECKED	REVIEWED	APPROVED
3	2025.02.05	REVISED AS PER MARKED	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO
2	2025.01.13	REVISED AS PER MARKED	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO
1	2024.12.24	REVISED AS PER MARKED	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO
0	2024.12.10	FIRST ISSUE	J.G.LIM	J.S.KIM	G.J.KANG	G.H.CHO

APPLICABLE CODE		ASME B31.1(2022)	CODE JURISDICTION	NBEP
DESIGN	PRESS.	10 bar (g)	INSULATION(Y/N)	N
	TEMP.	80 °C	END BEVEL TYPE	A
COATING		26-21-00-PRO-MM-0802-001	STAMP(Y/N)	N
HYDROSTATIC TEST(Y/N)		N	TEST PRESSURE	- bar (g)

WELD TABLE					NDE TABLE									
JOINT NO.	MAT'L	SIZE	THK.	WELD TYPE	RT	UT	MT	PT	VT	HT	PMI	PWHT (Y/N)	WPS NO.	REMARK
4A	C/S	10"	6.35T	BW	100%	-	-	-	100%	-	-	N	SH-0101-GF-18	-
6	C/S	10"	6.35T	BW	100%	-	-	-	100%	-	-	N	SH-0101-GF-18	-
8	C/S	10"	6.35T	BW	100%	-	-	-	100%	-	-	N	SH-0101-GF-18	-
9	C/S	10"	6.35T	BW	100%	-	-	-	100%	-	-	N	SH-0101-GF-18	-
3	C/S	OD357.8	6.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-

WELD TABLE					NDE TABLE									
JOINT NO.	MAT'L	SIZE	THK.	WELD TYPE	RT	UT	MT	PT	VT	HT	PMI	PWHT (Y/N)	WPS NO.	REMARK
4	C/S	OD357.8	6.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
5	C/S	OD357.8	6.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-
7	C/S	OD357.8	6.00T	FIL	-	-	-	-	100%	-	-	N	SH-0101-GF-18	-

EXPLANATION FOR WELD TABLE AND NDE TABLE

RT=RADIOGRAPHIC EXAMINATION, UT=ULTRASONIC EXAMINATION, MT=MAGNETIC PARTICLE EXAMINATION, PT=LIQUID PENETRATION EXAMINATION, VT=VISUAL EXAMINATION, HT=HARDNESS TESTING, PMI=POSITIVE MATERIAL IDENTIFICATION,**.*T: NOMINAL WALL THK., M**.*: MINIMUM WALL THK.

WELD TYPE: BW=BUTT WELD, O-LET= BRANCH WELD(WELDOLET, SOCKOLET, ...), SW=SOCKET WELD, GW=GROOVED(OR W/ FILLET) WELD, FIL=FILLET WELD, SEAL=SEAL WELD, TACK=TACK WELD, THRD=THREADED JOINT, HOLE= HOLE WITHOUT WELDING(RT HOLE, ...), - = NO MAIN WELDING

PARTS	A	MAT'L INSP.(M/K,C/T)	B	FIT-UP	C	WELDING	D	PWHT	E	NDE	F	FINAL INSP.
PD	H		H		H		H				H	
QC	H		H		H		H		H		H	
CUSTOMER												
RECORD NO.												

Project: UTE Azulão 950 MW

Customer: elecnor

Manufacturer: SEONGHWA

Title: PREFABRICATED PIPE SPOOL DRAWING
MAIN CIRCULATING WATER SYSTEM

FAB. ISOMETRIC DRAWING NUMBER	20GMA30BR002_UAY00Y-B1	SCALE	NONE
		SHEET	1/1
SPOOL DRAWING NUMBER	20GMA30BR002_UAY00Y-B1_SP-002	SERIAL NUMBER	AZUM011

A4 (210 x 297mm/mm)