


BATTERY INPUT — HAND FIT 3568 HOLDER AFTER PCBA / USER FIT 0297010.WXNV 10 A, 32 VDC, 1 kA interrupt / external UV disconnect ≥ 9.0 V / no active OVP

USB HUB 3S V4

POWER ENABLE — SW1 hard-off control / OFF-state and ground test points

Page 2 of 10 • exact circuit.json SHA-256 0bca19d0da74d36e... • 4 components • landscape page fit


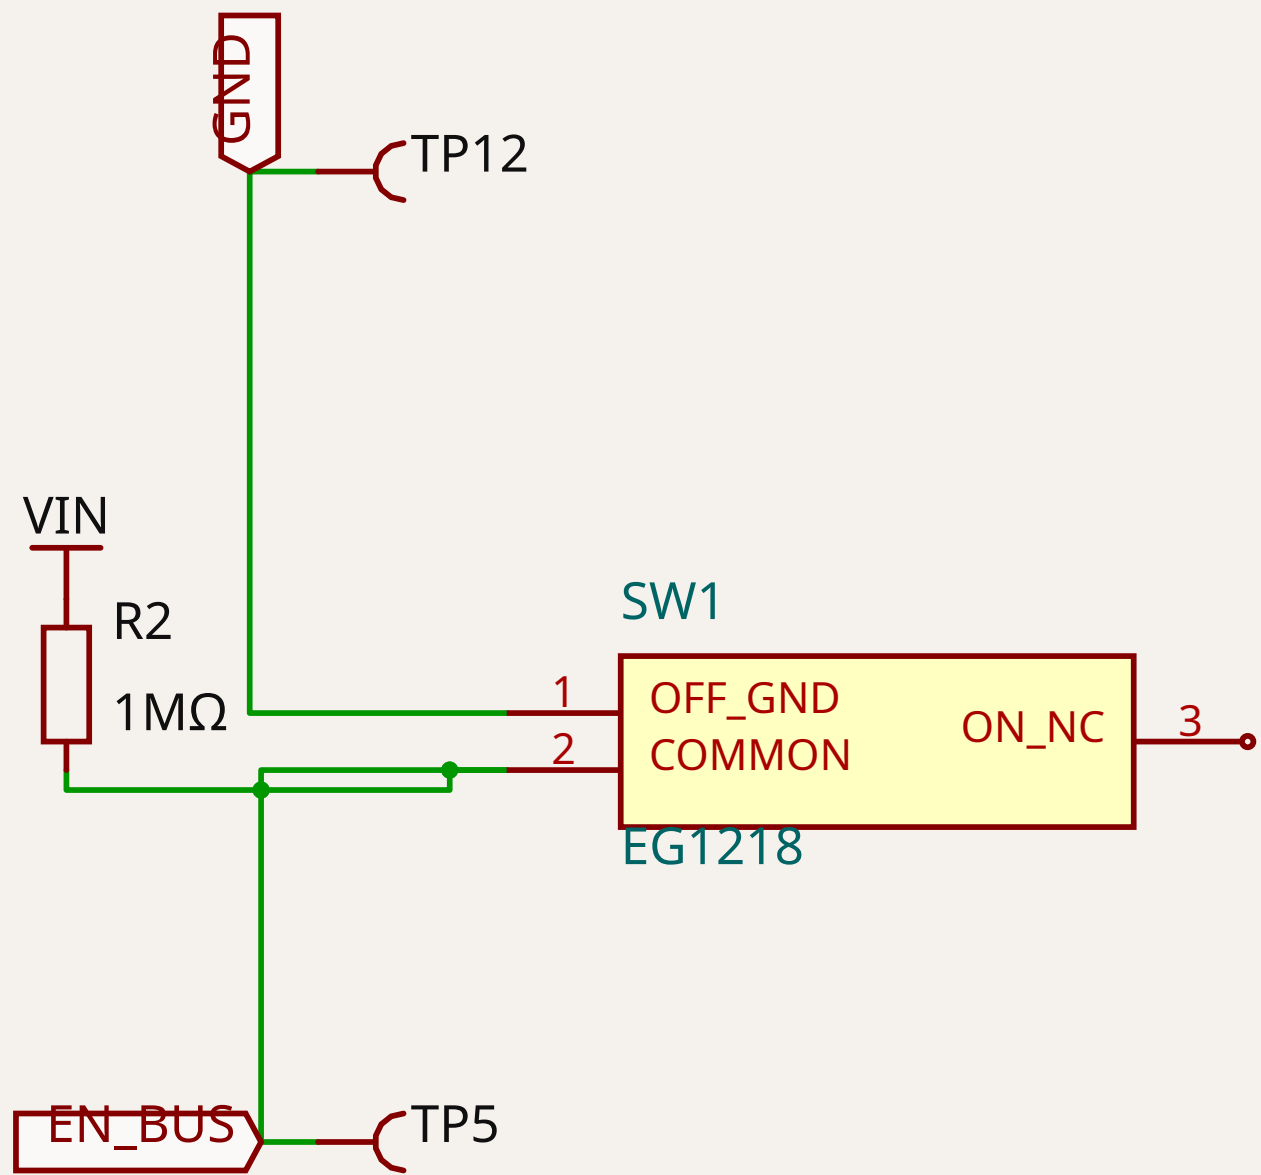


USB-A AGGREGATE PROTECTION — U9 TPS259827 no-OVLO circuit breaker

[illegible]


USB HUB 3S V4

USB-A CHARGING SIGNATURES — TPS2513A / no upstream data / U8 channel 2 open

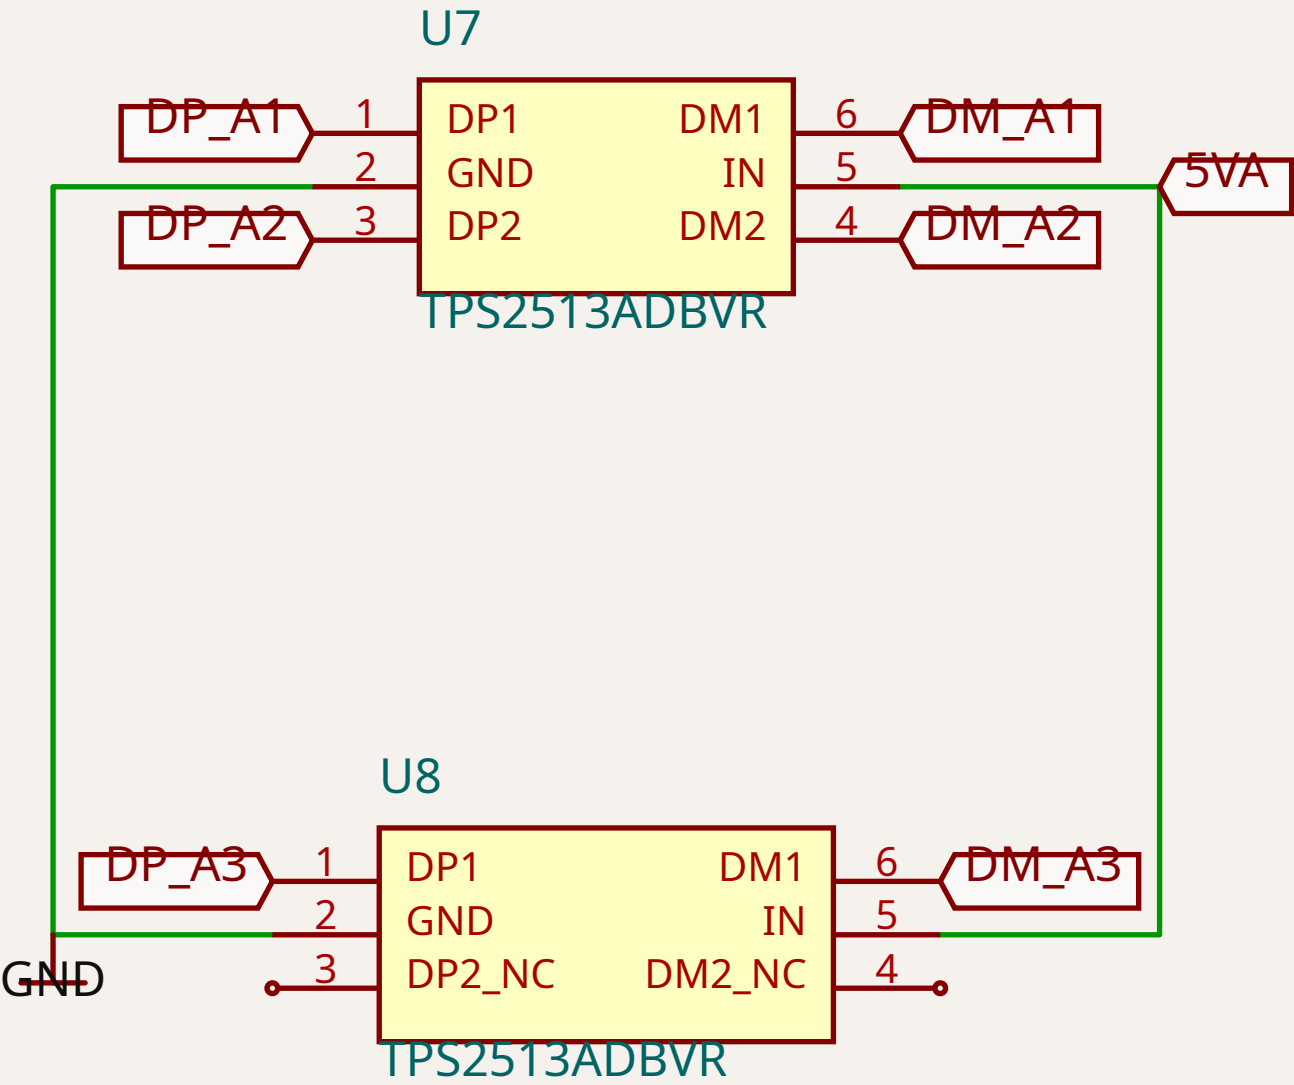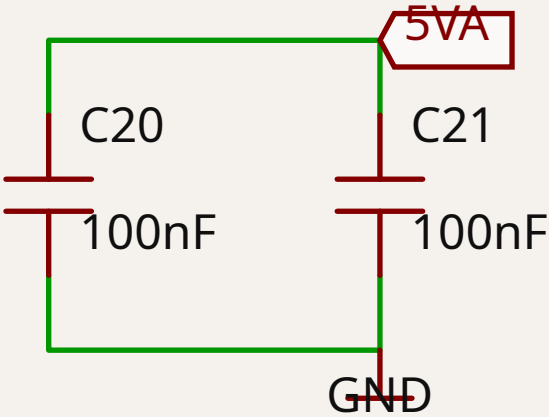


USB HUB 3S V4

USB-A PORT 1 — independent TPS2559 current limit / POWER ONLY

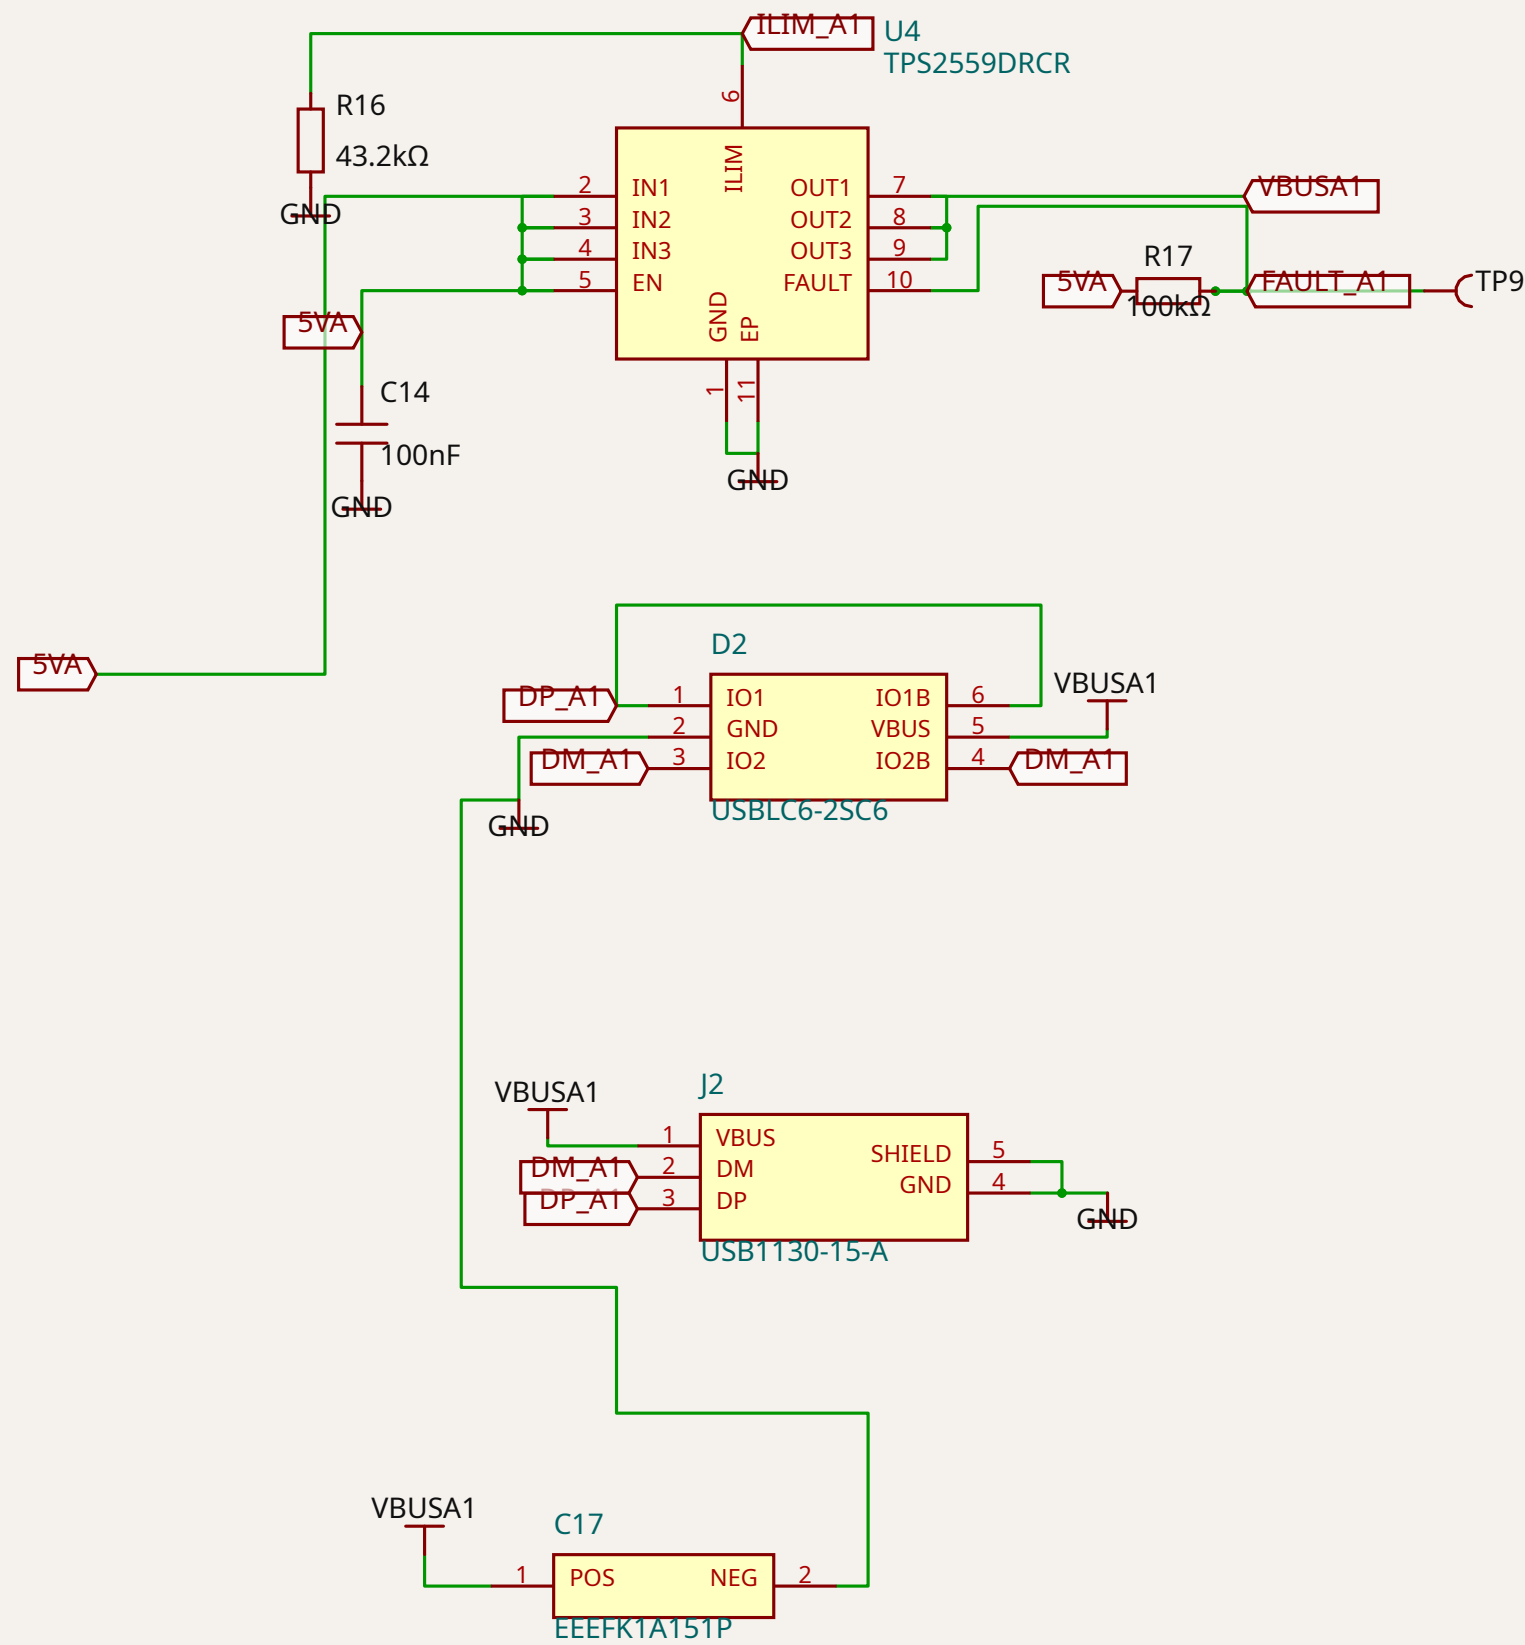


USB HUB 3S V4

USB-A PORT 2 — independent TPS2559 current limit / POWER ONLY

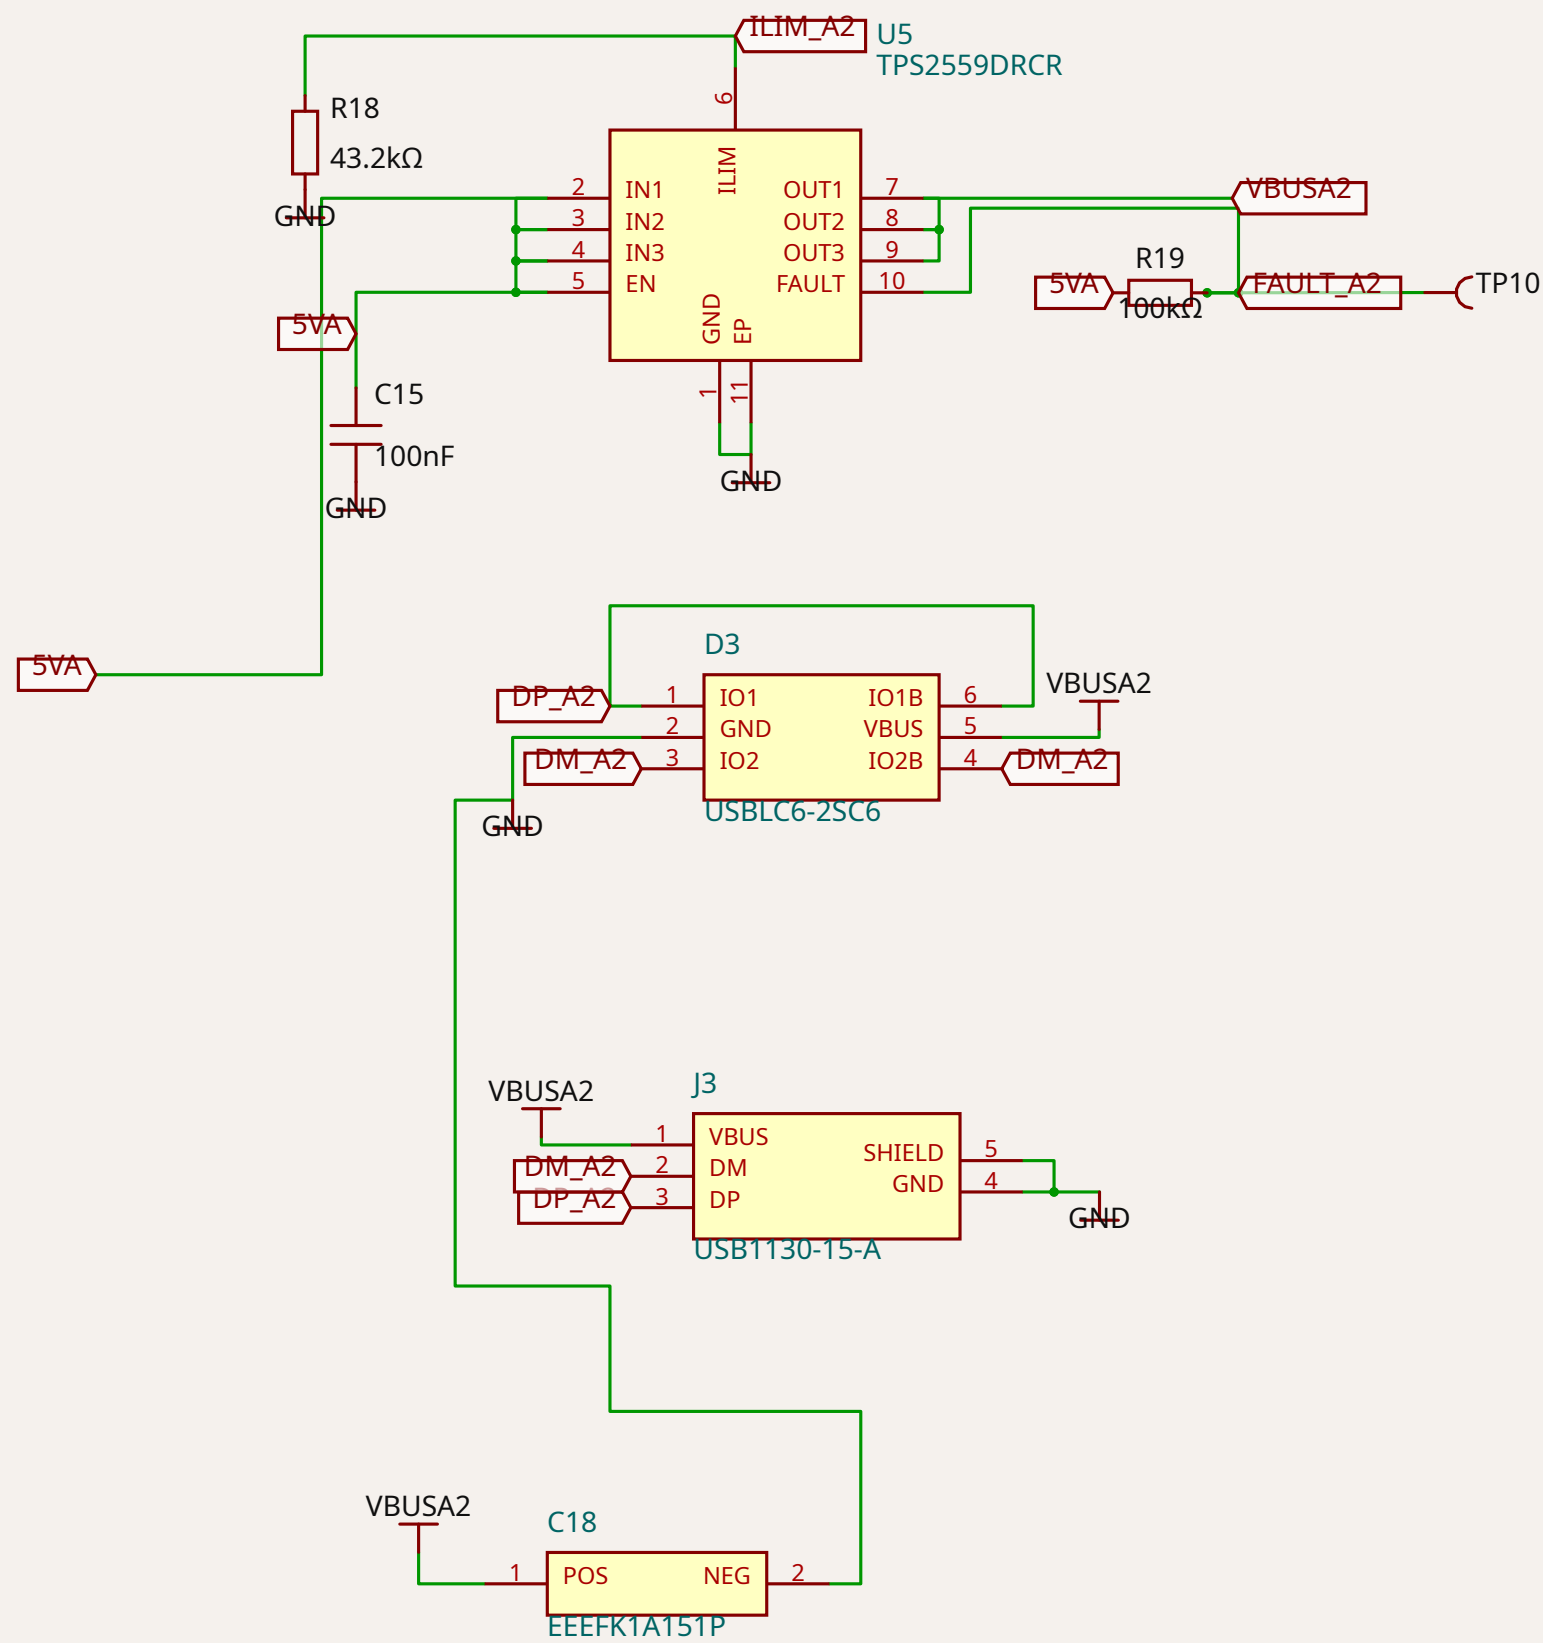


USB HUB 3S V4

USB-A PORT 3 — independent TPS2559 current limit / POWER ONLY

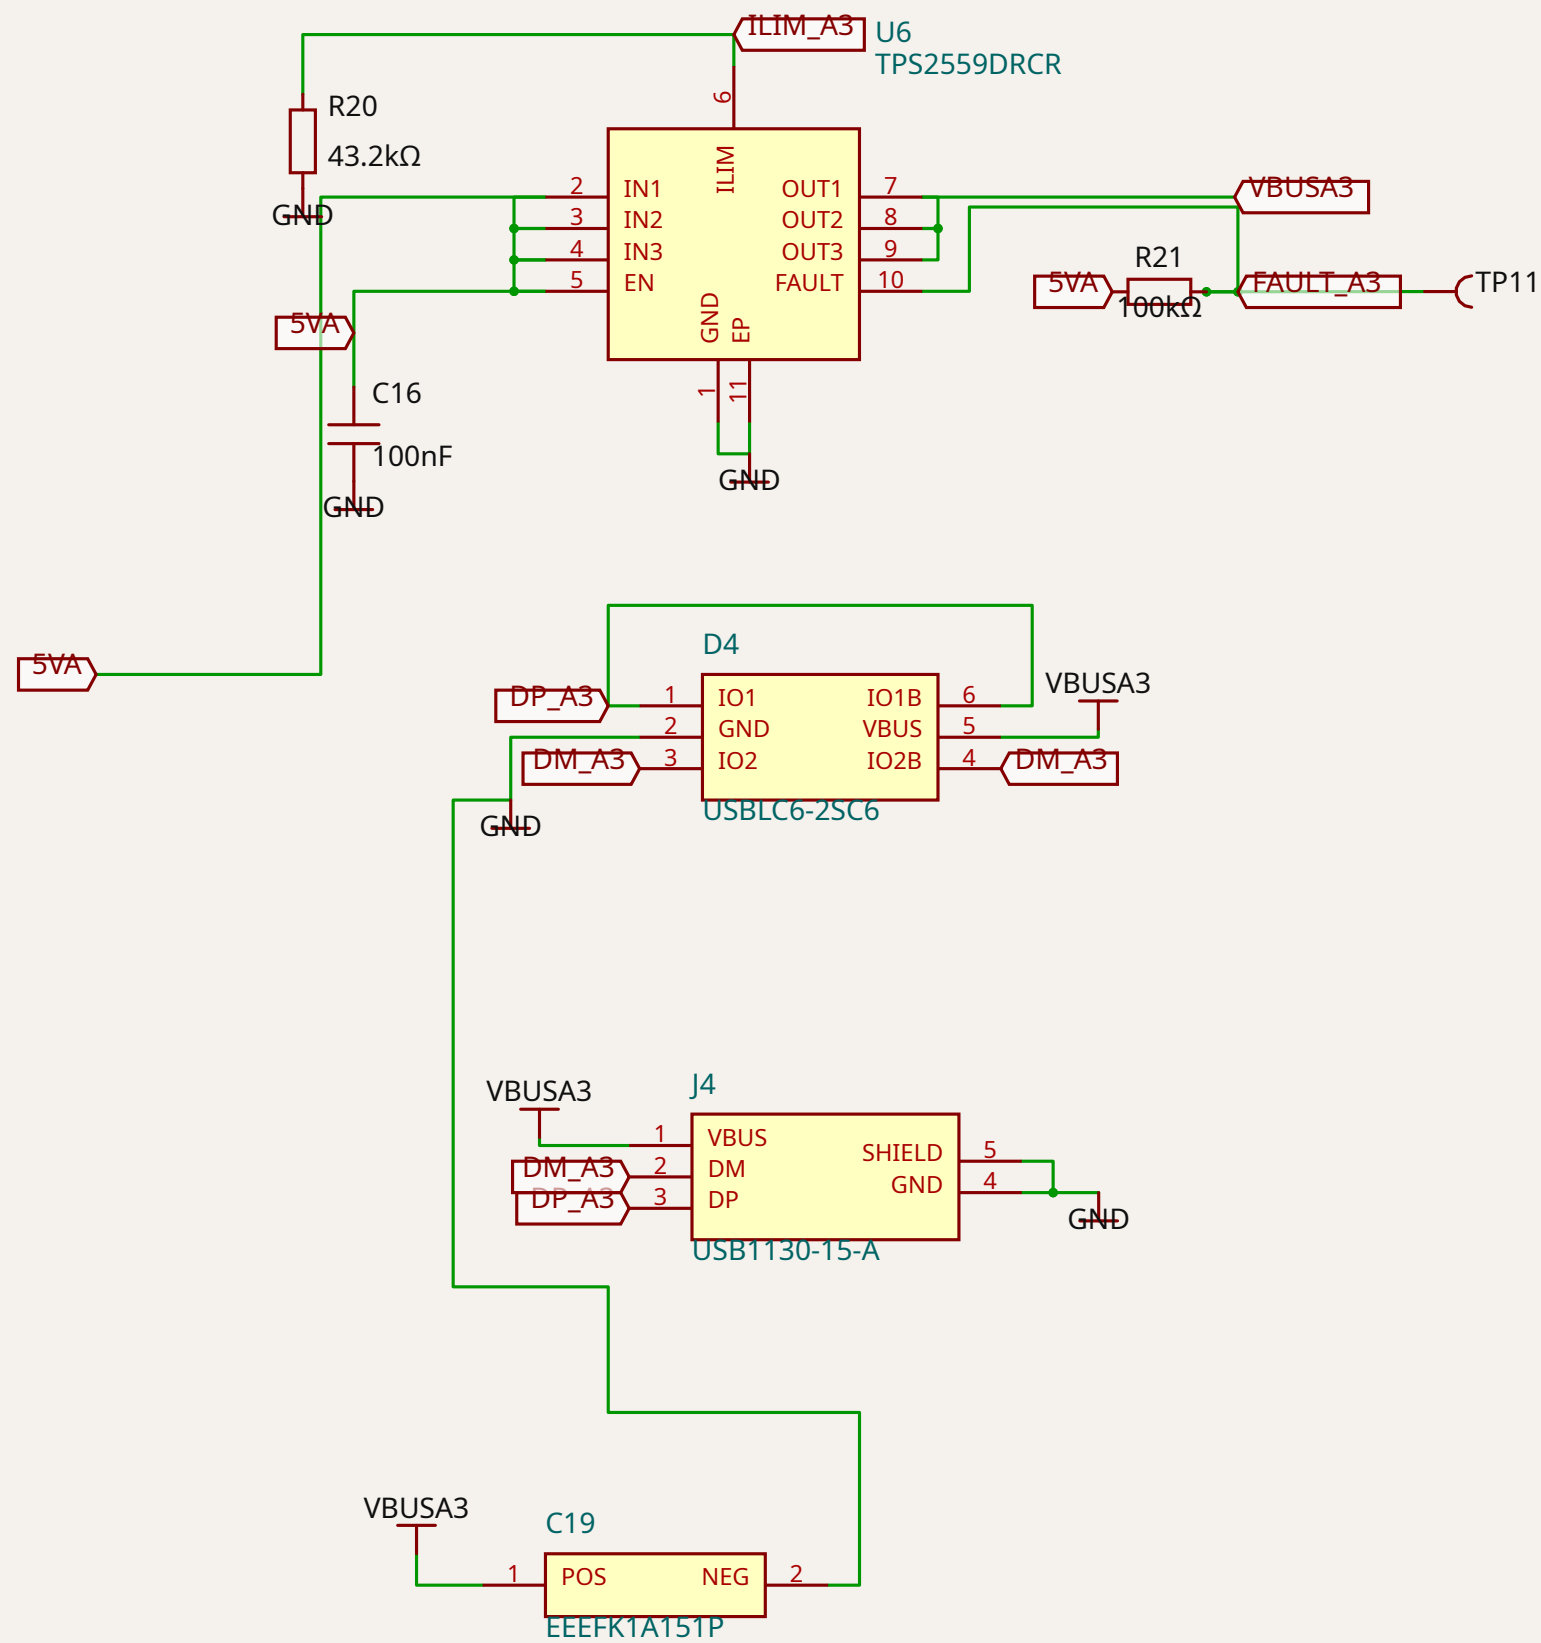

USB HUB 3S V4

USB-C SUPPLY — U2 TPSM63604RDLR / 5.15 V / 15 mV reserve / SW and VCC intentionally open per TI

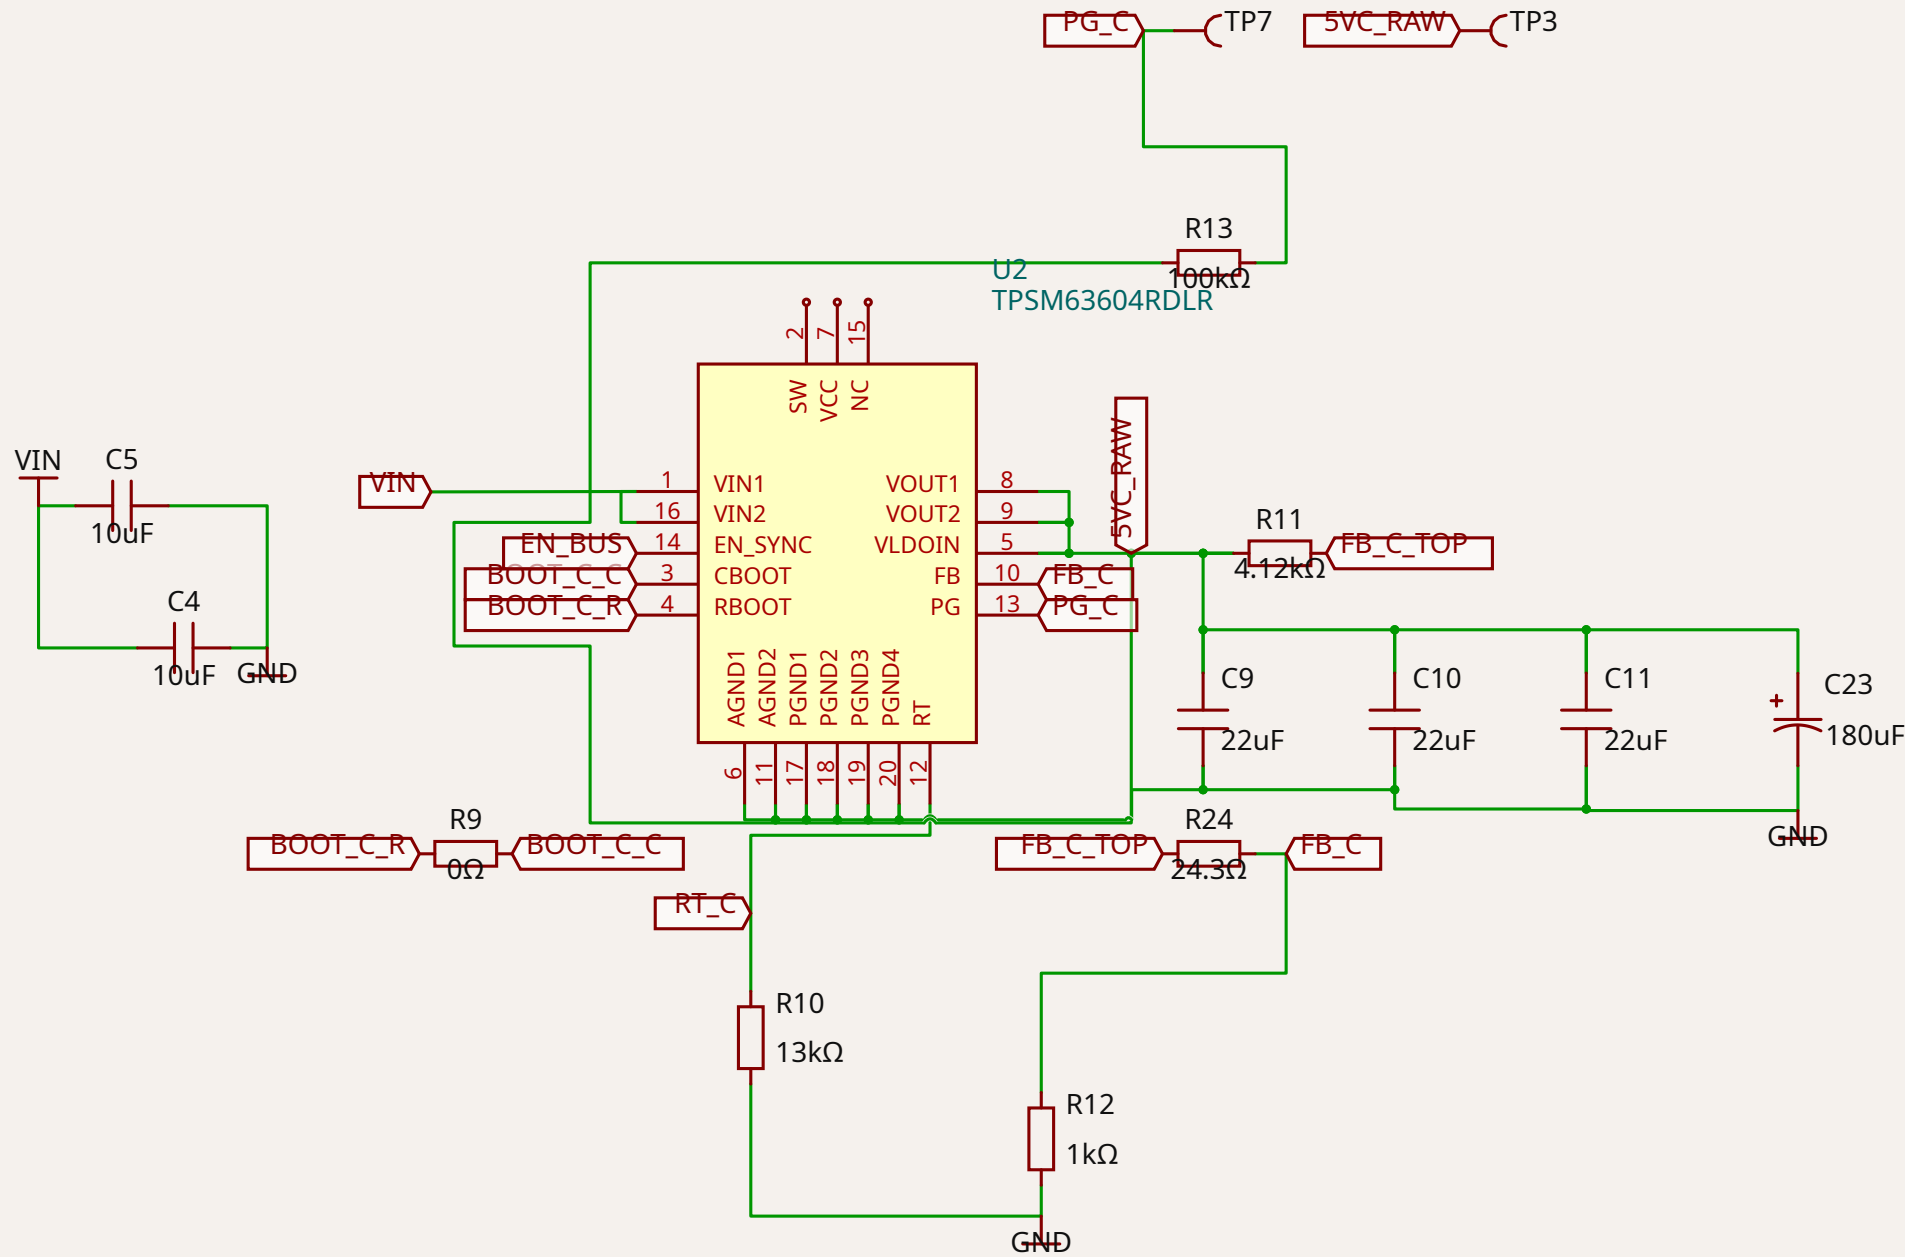

USB HUB 3S V4

USB-C OUTPUT — fixed 5 V / no PD or data / D+/D–, SBU and unused U3 status pins open

