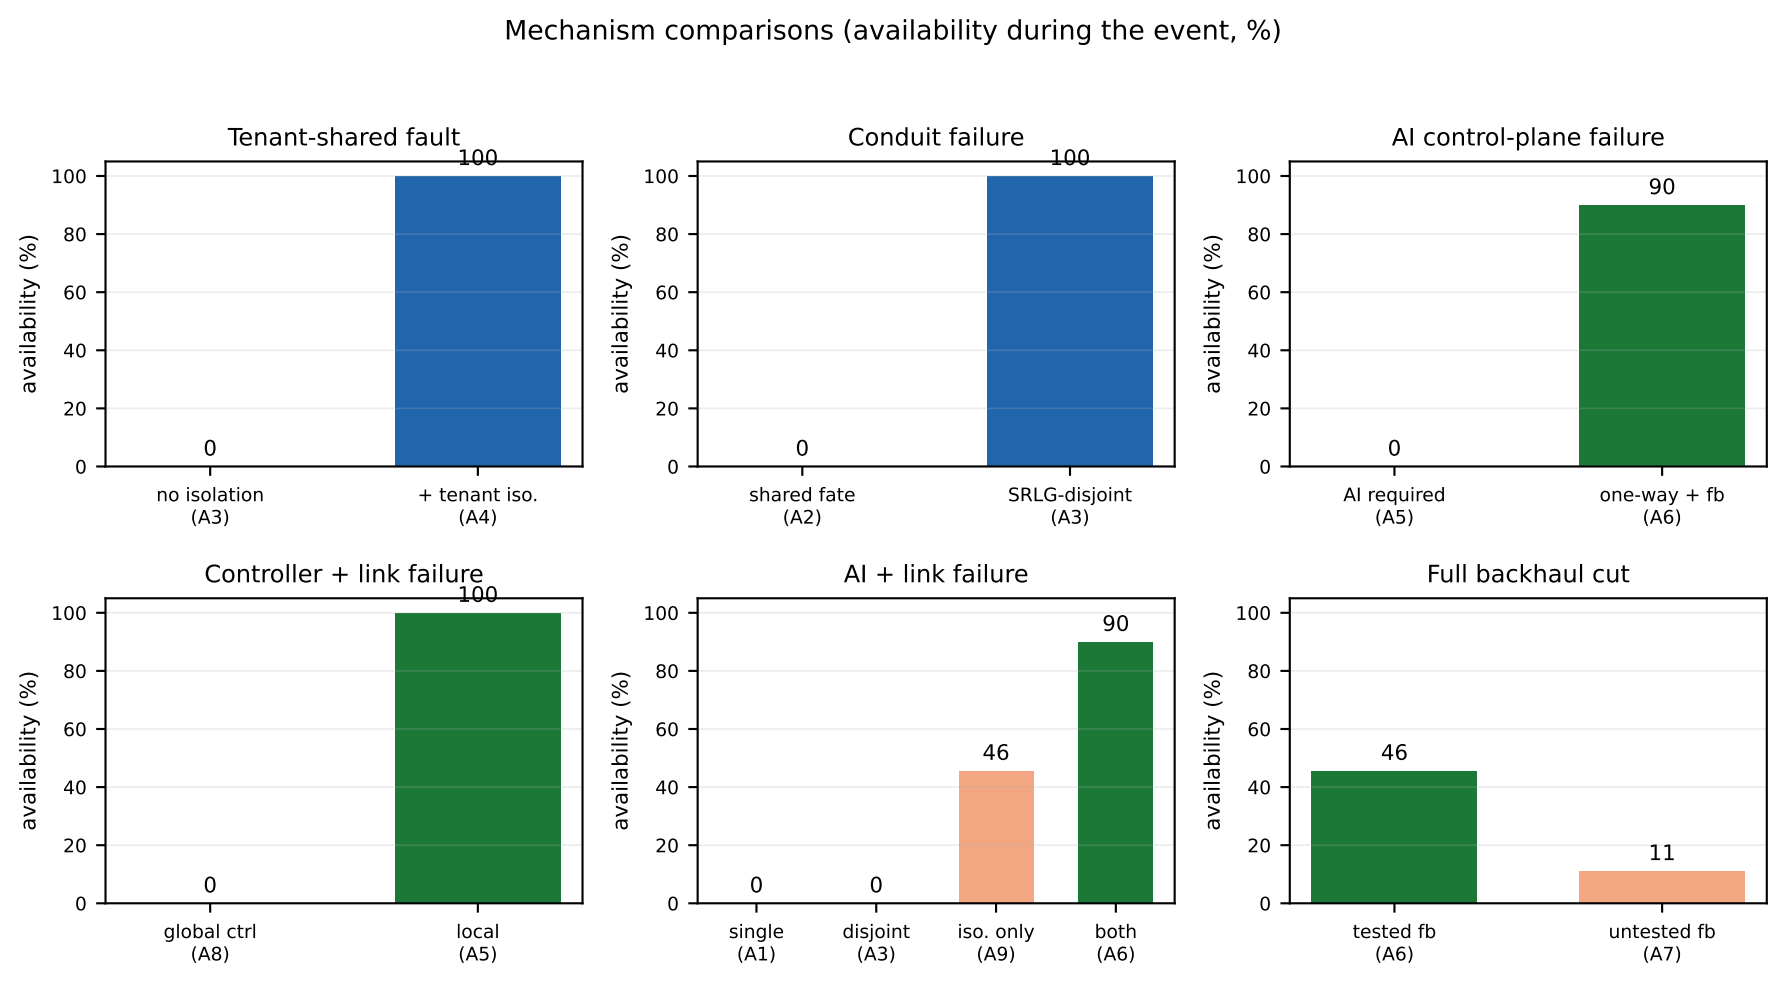
Mechanism comparisons (availability during the event, %)
Tenant-shared fault
availability (%)
0
100
no isolation (A3)
+ tenant iso. (A4)
Conduit failure
0
100
shared fate (A2)
SRLG-disjoint (A3)
AI control-plane failure
0
90
AI required (A5)
one-way + fb (A6)
Controller + link failure
0
100
global ctrl (A8)
local (A5)
AI + link failure
0
0
46
90
single (A1)
disjoint (A3)
iso. only (A9)
both (A6)
Full backhaul cut
46
11
tested fb (A6)
untested fb (A7)