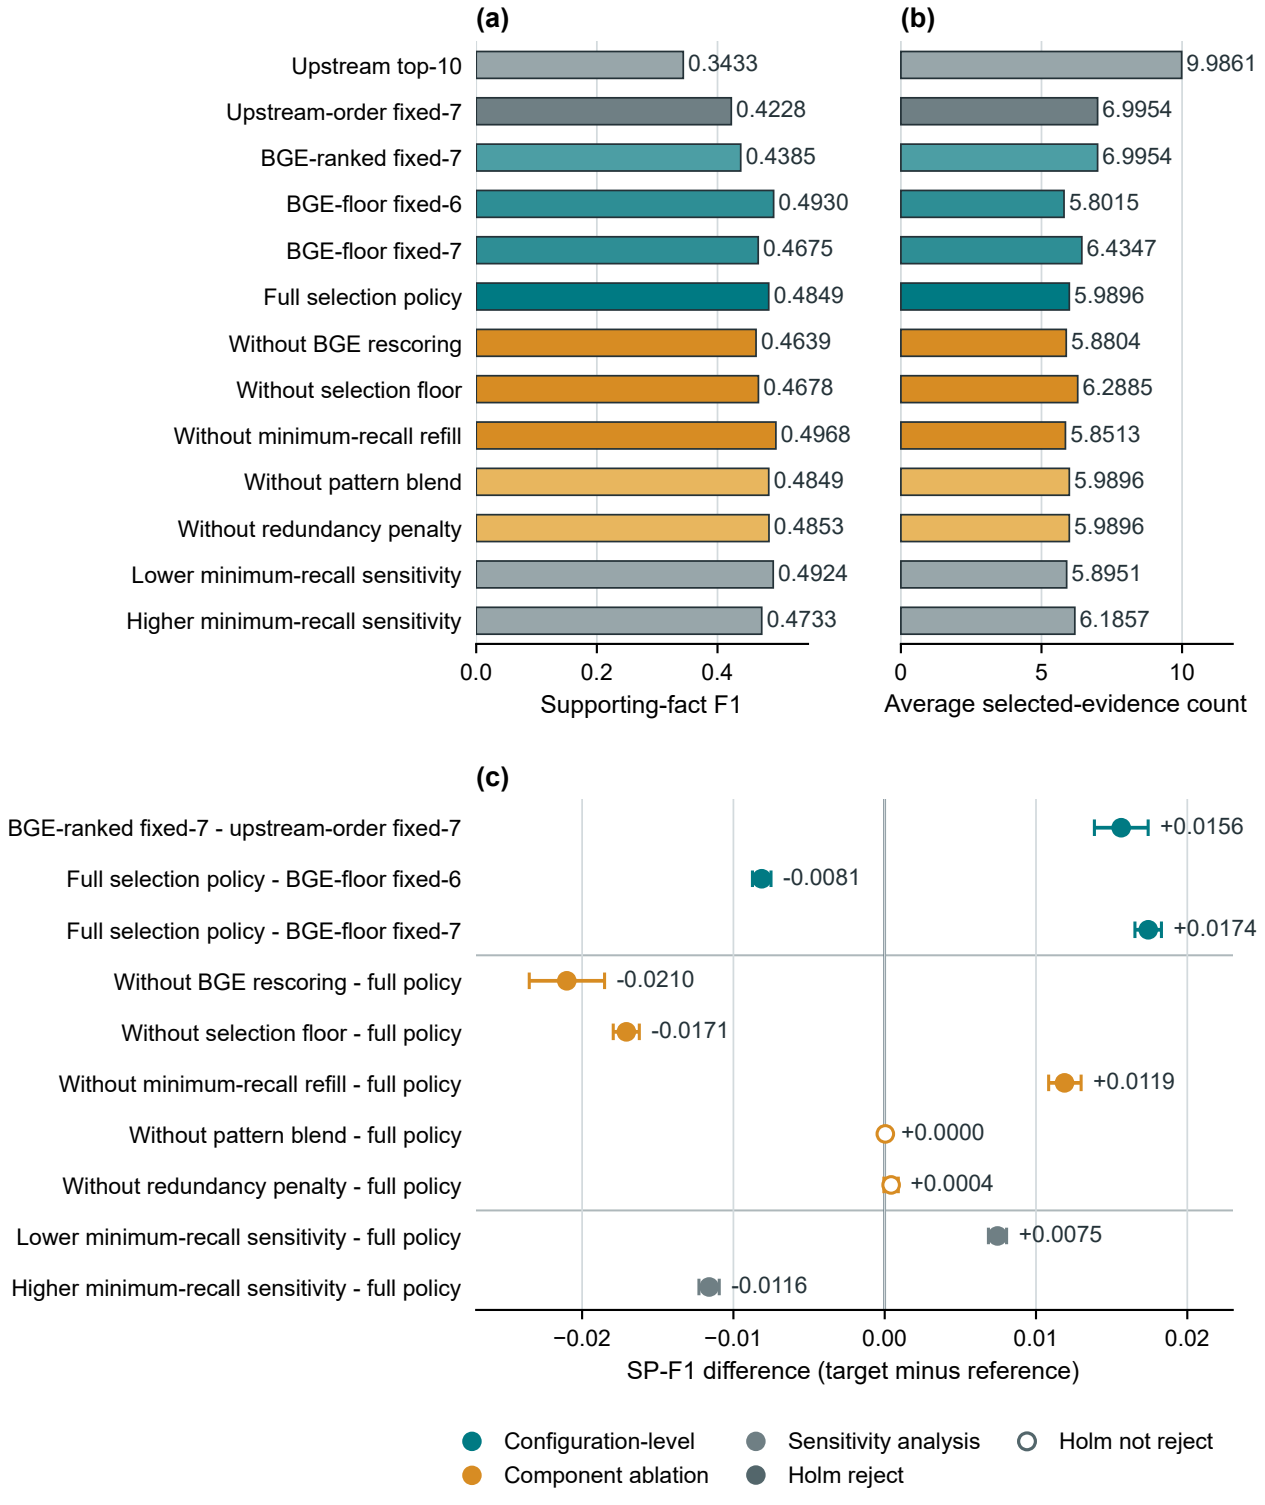
(a)
Upstream top-10
Upstream-order fixed-7
BGE-ranked fixed-7
BGE-floor fixed-6
BGE-floor fixed-7
Full selection policy
Without BGE rescoring
Without selection floor
Without minimum-recall refill
Without pattern blend
Without redundancy penalty
Lower minimum-recall sensitivity
Higher minimum-recall sensitivity
0.3433
0.4228
0.4385
0.4930
0.4675
0.4849
0.4639
0.4678
0.4968
0.4849
0.4853
0.4924
0.4733
0.0
0.2
0.4
Supporting-fact F1
(b)
9.9861
6.9954
6.9954
5.8015
6.4347
5.9896
5.8804
6.2885
5.8513
5.9896
5.9896
5.8951
6.1857
0
5
10
Average selected-evidence count
(c)
BGE-ranked fixed-7 - upstream-order fixed-7
Full selection policy - BGE-floor fixed-6
Full selection policy - BGE-floor fixed-7
Without BGE rescoring - full policy
Without selection floor - full policy
Without minimum-recall refill - full policy
Without pattern blend - full policy
Without redundancy penalty - full policy
Lower minimum-recall sensitivity - full policy
Higher minimum-recall sensitivity - full policy
+0.0156
-0.0081
+0.0174
-0.0210
-0.0171
+0.0119
+0.0000
+0.0004
+0.0075
-0.0116
−0.02
−0.01
0.00
0.01
0.02
SP-F1 difference (target minus reference)
Configuration-level
Component ablation
Sensitivity analysis
Holm reject
Holm not reject