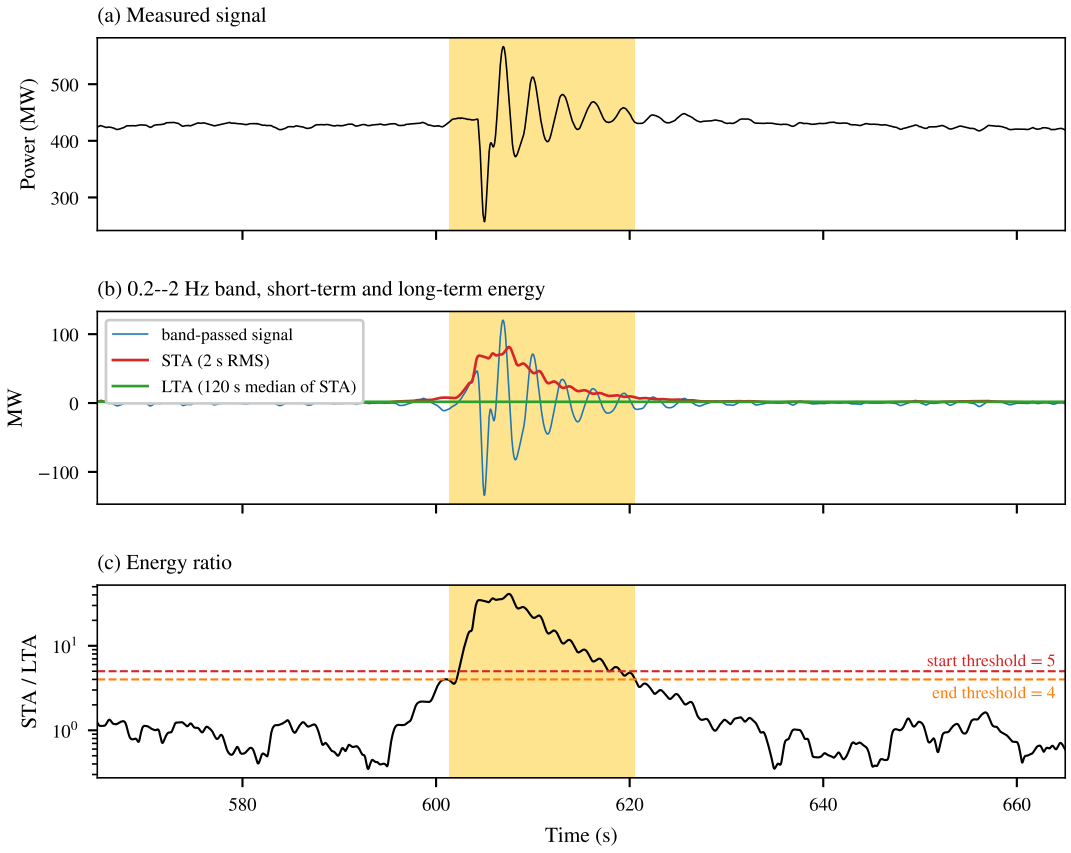
(a) Measured signal
Power (MW)
500
400
300
(b) 0.2--2 Hz band, short-term and long-term energy
band-passed signal
STA (2 s RMS)
LTA (120 s median of STA)
MW
100
0
−100
(c) Energy ratio
STA / LTA
10^1
10^0
start threshold = 5
end threshold = 4
580
600
620
640
660
Time (s)