


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 10-08-2023 08:17:35

STREAM NO.:4004

REV. CAUSE ID: 1

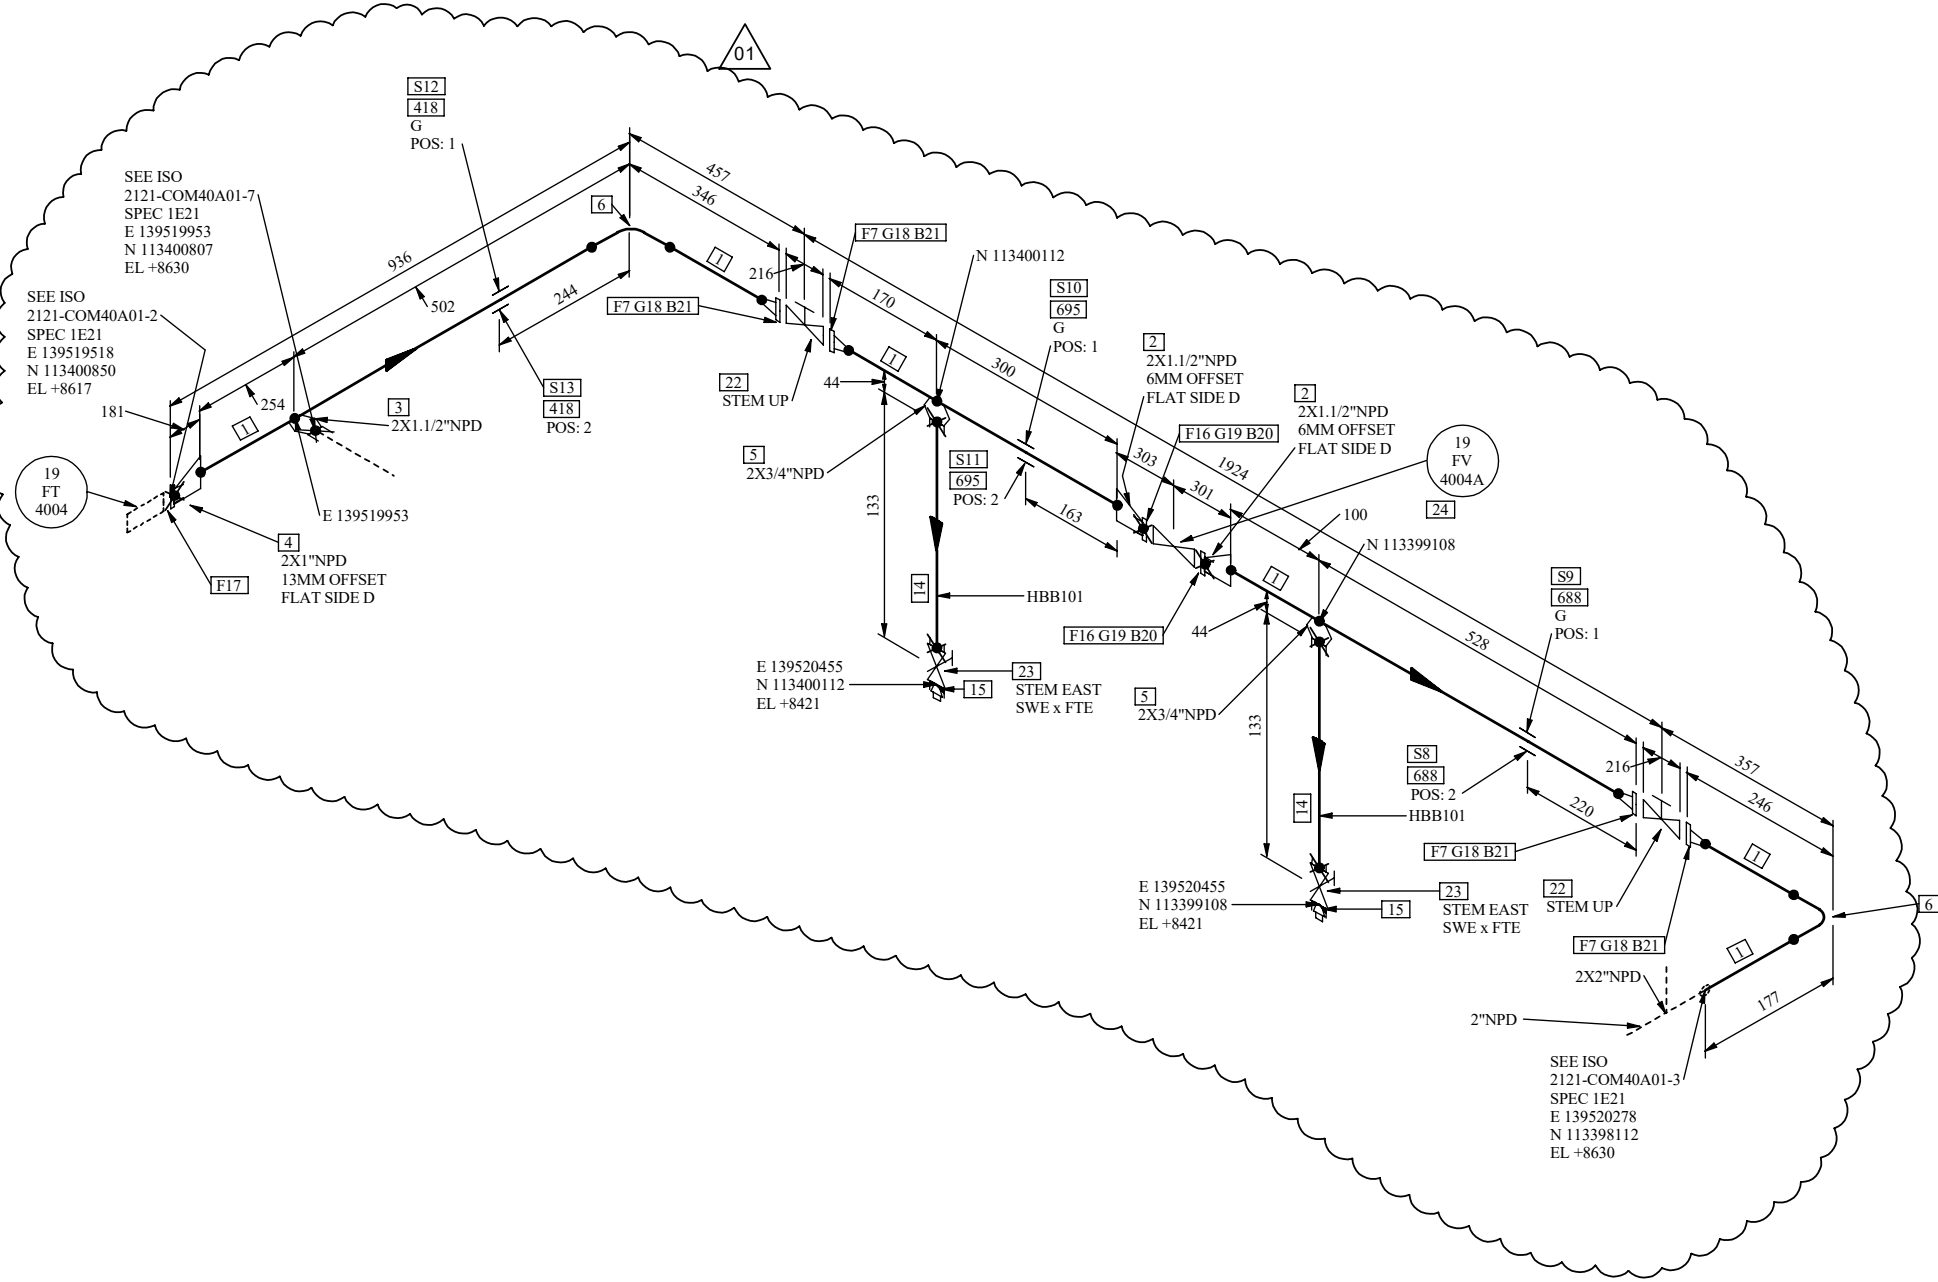

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:  DENOTES PARTS LIST NO  PIPE SUPPORT  A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	STRESS CALC. N°
01	ISSUED FOR CONSTRUCTION	10-AUG-23	M.YADAV	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 28
00	ISSUED FOR CONSTRUCTION	03-FEB-23	M.YADAV	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
							PIPE LAYOUT N° 19-L-19-000-2-00-86197 sheet 3

APPROVED FOR
CONSTRUCTION



Signature for construction is shown
on Iso list of relevant CWA

TITLE
**ISOMETRIC DRAWING
LINE**

2"-COM-40A01-1E21

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B BE SMLS T01AC03V02 S-STD <PIPA010B12STD> (L-7806)	2	I117862	2.1 M	
FITTINGS					
2	ECCENTRIC SWAGE MSS SP-95 - A234-WPB BE PE SMLS SCH1-STD SCH2-XS R22FQC04VZ15 <ESWA010GR14151316> (L-ESW27)	2X1.1/2	1920268	2	
3	REDUCING SOCKOLET MSS-SP-97 3000# A105N BE SWE - R13DNC44V101 NREQD <SOKA300LB01413> (L-343)	2X1.1/2	17843413	1	
4	ECCENTRIC SWAGE MSS SP-95 - A234-WPB BE PE SMLS SCH1-STD SCH2-XS R22FQC04VZ15 <ESWA010GR14151216> (L-ESW27).	2X1	1920266	1	
5	REDUCING SOCKOLET MSS-SP-97 3000# A105N BE SWE - R13DNC44V101 NREQD <SOKA300LB01411> (L-343)	2X3/4	17843411	2	
6	90 LR ELBOW ASME B16.9 A234-WPB BE SMLS C01DC04V01 S-STD <90LA200F32STD> (L-7955)	2	1128529	2	
FLANGES					
7	WN FLANGE ASME B16.5 300# A105N RFFE BE 125 - 250 AARH F01CFC44BV05 S-STD <WNFA300R352STD> (L-236)	2	15355797	4	
PIPE SUPPORTS					
8	STAKES SUPPORTS ST05 HEA100	2	688	1	
9	STANDARD GUIDE FOR NOT INS. PIPING-N1G1	2	688	1	
10	STANDARD GUIDE FOR NOT INS. PIPING-N1G1	2	695	1	
11	STAKES SUPPORTS ST05 HEA100	2	695	1	
12	STANDARD GUIDE FOR NOT INS. PIPING-N1G1	2	418	1	
13	STAKES SUPPORTS ST02 L100X100X10	2	418	1	
PIPE					
14	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A13/4XS> (L-6679)	3/4	I132785	0.3 M	
FITTINGS					
15	PLUG ROUND HEAD ASME B16.11 - A105N MTE NREQD - R42FQC44W001 NREQD <PLUA300CK3/4> (L-77)	3/4	I10088232	2	
FLANGES					
16	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R3511/2XS> (L-375)	1.1/2	19762192	2	
17	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R351XS> (L-375).	1	I4217823	1	
GASKETS					
18	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP1IS12 <N/A> (N/A)	2	163508961	4	
19	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP1IS12 <N/A> (N/A)	1.1/2	163508953	2	
BOLTS					
20	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G3/431/2> - 2 NUTS PER BOLT - 90 mm Length	3/4	153437635	8	
21	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G5/831/2> - 2 NUTS PER BOLT - 90 mm Length	5/8	153437440	32	
VALVES / IN-LINE ITEMS					
22	GATE VALVE API 600 300# A216-WCB RFFE 8-F6&HF API 600 B7/2H 125 - 250 AARH BB-OS&Y FLXW API 600 HW ASME B16.5 V01FFC29B167 NREQD <G42L-130> (L-130)	2	I5606081	2	
23	GATE VALVE API 602 800# A105N SWE FTE 8-F6&HF WB-OS&Y SOW API 602 HW V01GIC4412BL NREQD <N/A> (N/A)	3/4	I10015410	2	
INSTRUMENTS					
24	INSTRUMENT COMPONENT	1.1/2	19-FV-4004A	1	

PIPE MATERIAL		NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.			
CS		2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102.			
HEAT TREATMENT (PWHT)		3. WELDING ACCORDING TO 45-L-45-000-2-00-80021.			
N		4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160.			
		5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".			
PAINTING SCHEME (3)		CONTRACTOR:	CONTRACTOR DRAWING NUMBER:		PROJECT:
I			4274-XH-DL-2121COM40A01-8		4001008
PIPING CLASS					
1E21					
WELDING CLASS (4)		 LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT			CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX
E					
PED CATEGORY					
II					
INSULATION CODE / THK. (mm)		ANNEX	SPEC.	DRAWING NUMBER	REV.
N 0		19	L	19-000-2-02-00001 sheet 2121COM40A01-8	01