


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 19-02-2024 20:14:39

STREAM NO.:3202 REV. CAUSE ID: 23



SEE ISO
2121-HPN91R01-1
SPEC 1E21
E 139516159
N 113390290
EL +8312

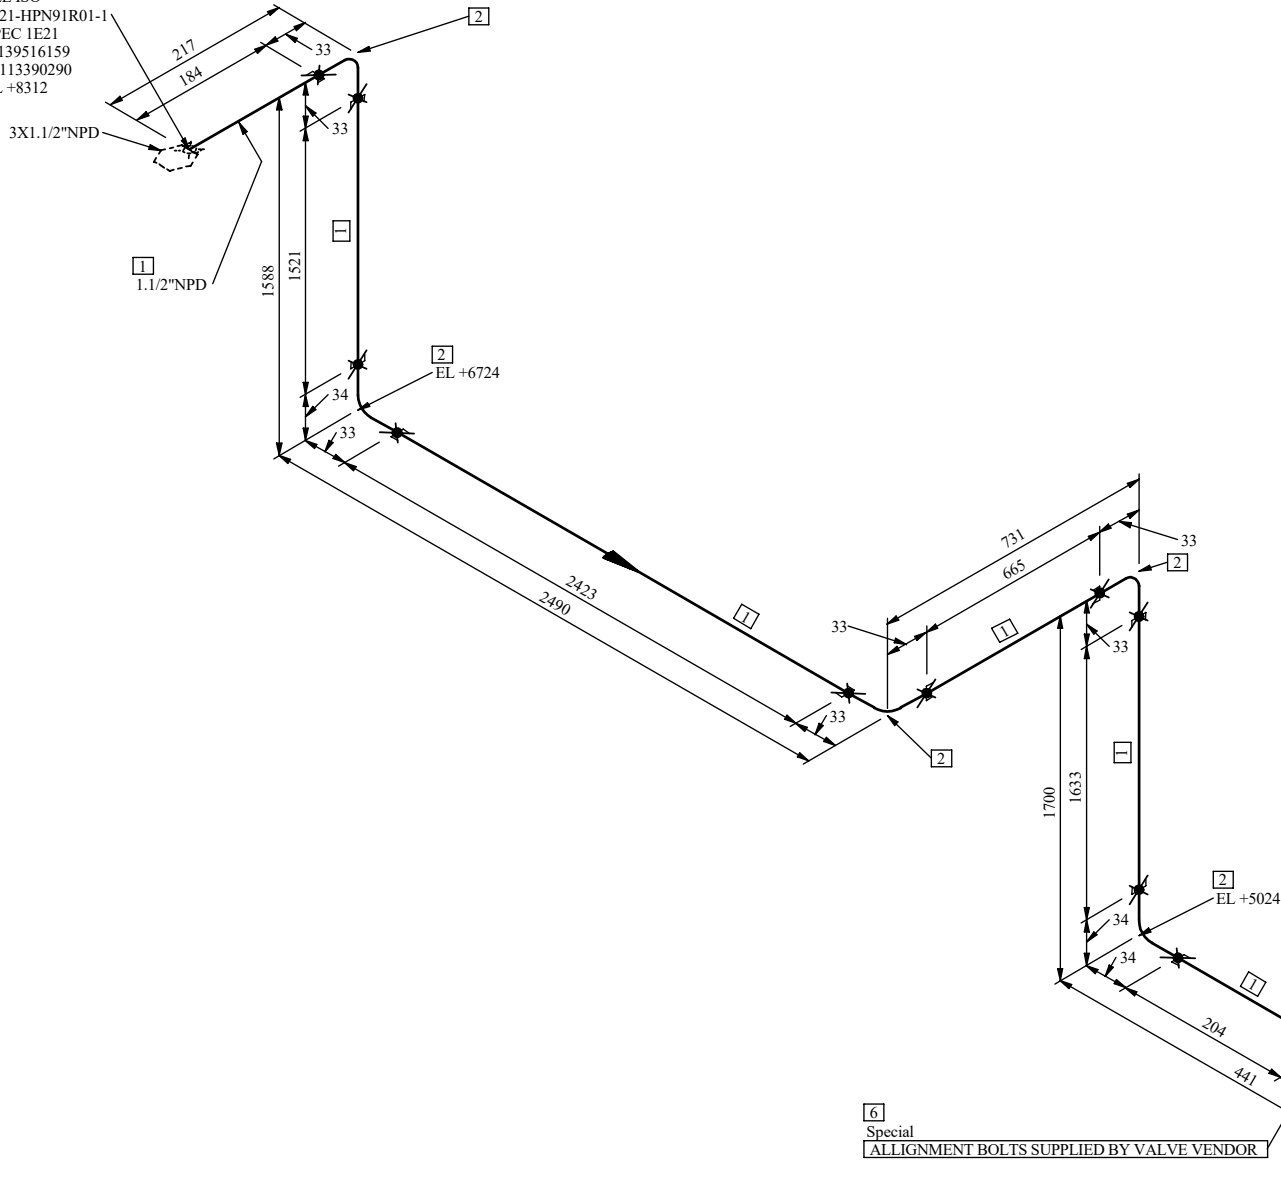

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✕ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND: [] DENOTES PARTS LIST NO PIPE SUPPORT A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE [] WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	STRESS CALC. N°
01	ISSUED FOR REFERENCE	23-FEB-24	M.YADAV	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 114
00	ISSUED FOR REFERENCE	07-APR-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
							PIPE LAYOUT N° 19-L-19-000-2-00-86196 sheet 2

ISSUED FOR REFERENCE

Signature for construction is shown on Iso list of relevant CWA

ISOMETRIC DRAWING LINE

1-1/2"-HPN-91R07-1E21

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A111/2XS> (L-6679)	1.1/2	I132809	6.8 M	
FITTINGS					
2	90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD <90FA300LBK11/2> (L-178)	1.1/2	I1651297	5	
FLANGES					
3	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R3511/2XS> (L-375).	1.1/2	I9762192	2	
GASKETS					
4	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP11S12 <N/A> (N/A)	1.1/2	I63508953	2	
BOLTS					
5	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G3/453/4> - 2 NUTS PER BOLT - 145 mm Length	3/4	I53437472	4	
VALVES / IN-LINE ITEMS					
6	DISC CHECK WFR VALVE ASME B16.34 300# A216-WCB RFTBE 316/PEEK 125 - 250 AARH SL VERTICAL&HORIZONTAL CRACKING PRESSURE AT 4.25 PSI ASME B16.5 V40JFC29P12 NREQD <N/A> (N/A).	1.1/2	I65527866	1	

PIPE MATERIAL	NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "~N/A~" MEANS UNICODE IS "NOT AVAILABLE".		
CS			
HEAT TREATMENT (PWHT)			
N			
PAINTING SCHEME (3)	CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
1		4274-XH-DL-2121HPN91R07-1	4001008
PIPING CLASS	LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT		
1E21	CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX		
WELDING CLASS (4)	ANNEX 19 SPEC. L DRAWING NUMBER 19-000-2-02-00001 sheet 2121HPN91R07-1		
E			
PED CATEGORY			
I			
INSULATION CODE / THK. (mm)			
N 0			
			REV. 01