
REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

2)

ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.

FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT

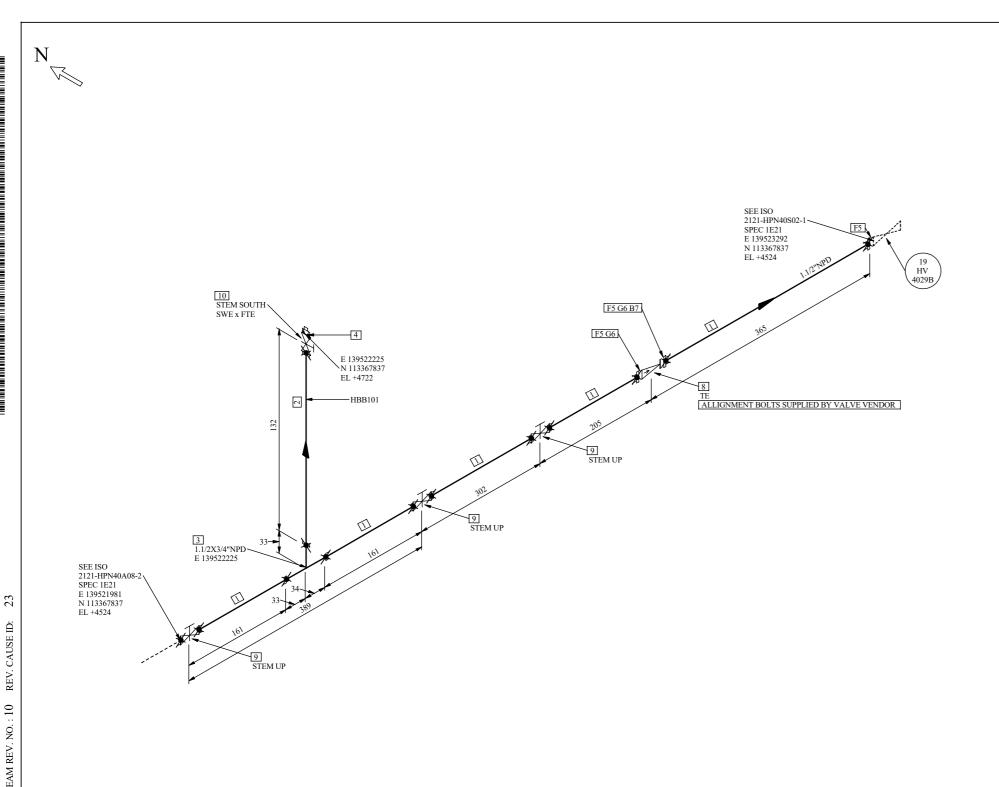

BILL OF MATERIAL HOLD COMPONENT DESCRIPTION ITEM CODE QTY STATUS (IN) PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A111/2XS> (L-6679). 1.1/2 I132809 0.9 M PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A13/4XS > (L-6679). 3/4 I132785 0.1 M REDUCING TEE ASME B16.11 3000# A105N SWE SWE - R12FNC441101 NREQD 1.1/2X3/4 11651306 <RTEA300KBK11/23/4> (L-RTE15). PLUG ROUND HEAD ASME B16.11 - A105N MTE NREQD - R42FQC44W001 NREQD 110088232 <PLUA300CK3/4> (L-77). SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS 19762192 1.1/2 <SWFA300R3511/2XS> (L-375). ASKETS SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 1.1/2 163508953 ASME B16.5 G03GFP1IS12 < N/A > (N/A) BOLTS STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I010B0301 153437472 <SB2R51G3/453/4> - 2 NUTS PER BOLT - 145 mm Length DISC CHECK WFR VALVE ASME B16.34 300# A216-WCB RFTBE 316/R-PTFE, GF 125 -110208506 250 AARH SL VERTICAL&HORIZONTAL CRACK. PRESS. 1/2 PSI ASME B16.5 V40JFC29P01 NREOD < N/A > (N/A) GATE VALVE API 602 800# A105N SWE SWE 8-F6&HF WB-OS&Y SOW API 602 HW I10015421 V01GIC4411BL NREQD < G611_2L-GA1313-B > (L-GA1313-B). GATE VALVE API 602 800# A105N SWE FTE 8-F6&HF WB-OS&Y SOW API 602 HW 110015410

13:10:05	5) GUS 6) CRO 7) IN O 8) ACT	XTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603. ETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002. SING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED. SE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN. AL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603). E EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.							
-2023	SUPPO	PPORTS LEGEND: DENOTES PARTS LIST NO PIPE — A=RESTING SUPPORT G=GUIDE F=AXIALS TOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.							
72-11								STRESS CALC. Nº	7
ATE: 7	01	ISSUED FOR REFERENCE	24-NOV-23	M.YADAV	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 28	
\Box	00	ISSUED FOR REFERENCE	14-APR-2023	M.YADAV	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602	
EXTR	REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86192 sheet 2	

Signature for construction is shown on Iso list of relevant CWA

ISSUED FOR

REFERENCE

PIPE MATERIAL

HEAT TREATMENT (PWHT)

PAINTING SCHEME (3)

INSULATION CODE / THK. (mm)

CS

ISOMETRIC DRAWING LINE

1-1/2"-HPN-40A08-1E21

NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.

ANNEX

2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102

DRAWING NUMBER

3. WELDING ACCORDING TO 45-L-45-000-2-00-80021

5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE" CONTRACTOR: CONTRACTOR DRAWING NUMBER: PROJECT:

PIPING CLASS 4001008 4274-XH-DL-2121HPN40A08-1 1E21 WELDING CLASS (4) LOW LINEAL DENSITY POLYETHILENE (PEL) AND POLYPROPYLENE (PP) PLANTS PED CATEGORY FOR PROJECT - ALBA PROJECT REPSQL

CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX

01

19-000-2-02-00001 sheet 2121HPN40A08-1