


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT  
PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 01-08-2023 13:45:55      STREAM NO.:3250      STREAM REV. NO. : 10      REV. CAUSE ID:

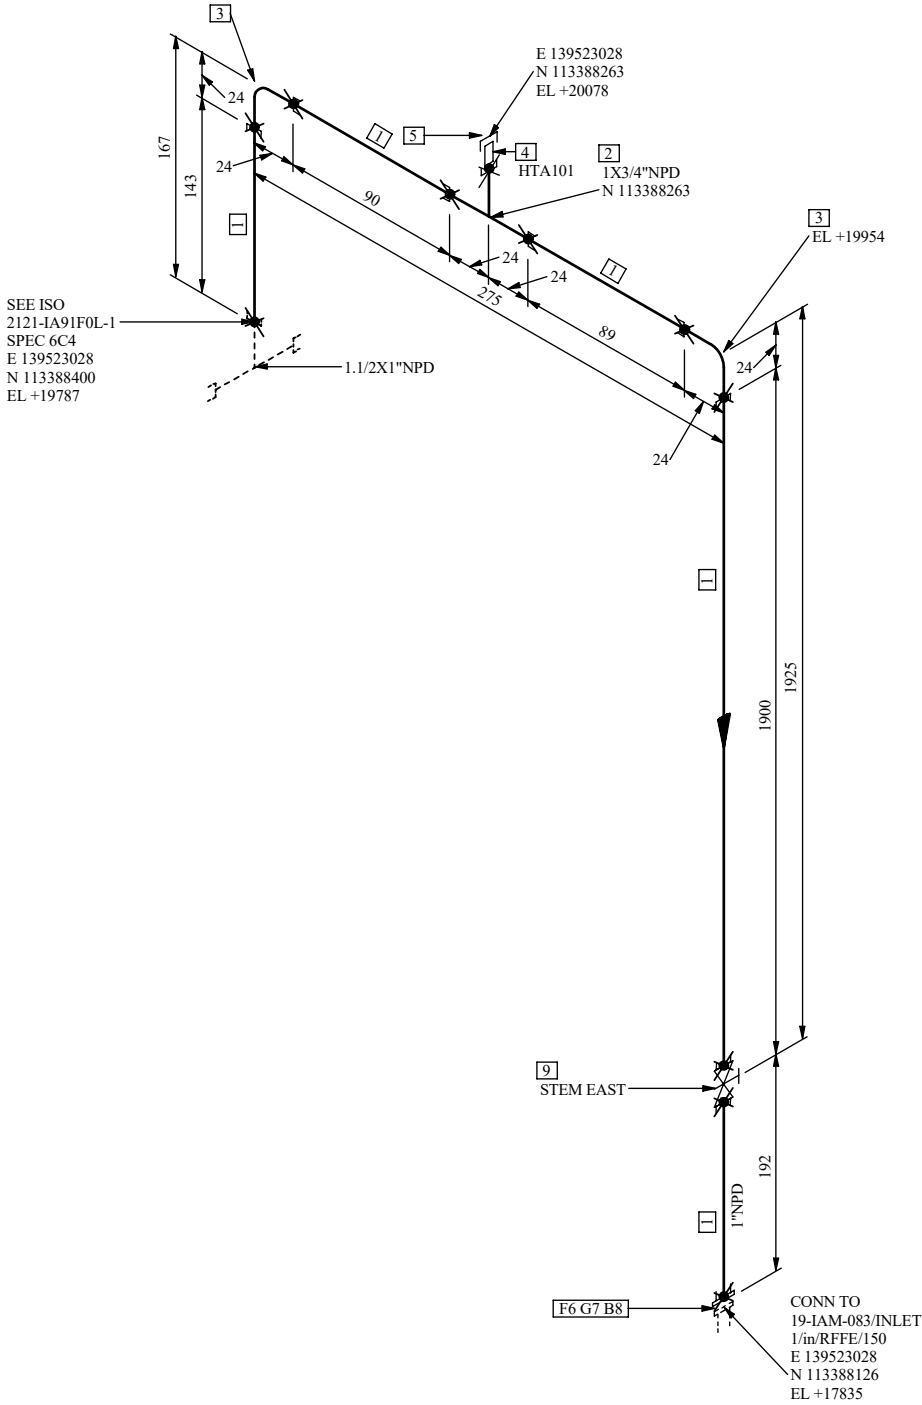

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✕ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:      □ DENOTES PARTS LIST NO      PIPE SUPPORT      A=RESTING SUPPORT      G=GUIDE      F=AXIAL STOP      B=ANCHOR      M=SPRING      S=TEFLON PAD      WHERE H A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							P & ID
							19-A-19-000-1-01-00001 sheet 106
00	ISSUED FOR REFERENCE	04-AUG-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N°
							19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N°
							19-L-19-000-2-00-86196 sheet 5

ISSUED FOR  
REFERENCE

Signature for construction is shown  
on Iso list of relevant CWA

ISOMETRIC DRAWING  
LINE

1"-IA-91F0N-6C4

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A312-TP304/304L DUAL GR PE SMLS T01AL2CZ02 S-40S <PIPB04DA2140S> (L-PIP111)	1	12257939	2.4 M	
FITTINGS					
2	REDUCING TEE ASME B16.11 3000# A182-F304/304L DUAL GR SWE SWE - R12FNL2A1101 NREQD <RTEB450LBK13/4> (L-RTE18)	1X3/4	12258205	1	
3	90 ELBOW ASME B16.11 3000# A182-F304/304L DUAL GR SWE SWE - R31FNL2A1103 NREQD <90FB450LBK1> (L-90F05)	1	12258117	2	
4	NIPPLE - - A312-TP304/304L DUAL GR PE MTE SMLS LENGTH 100mm R03AQL2CZW04 S-80S <NTOB04DE2110424> (L-NT009)	3/4	12258068	1	
5	CAP ASME B16.11 3000# A182-F304/304L DUAL GR FTE NREQD - R41FNL2A2001 NREQD <CATB450KBK3/4> (L-CAT04)	3/4	12259129	1	
FLANGES					
6	SW FLANGE ASME B16.5 150# A182-F304/304L DUAL GR RFFE SWE 125 - 250 AARH F02CDL2AB105 S-40S <SWFB450R15140S> (L-SWF30)	1	12260363	1	
GASKETS					
7	SPIRAL WOUND GASKET ASME B16.20 150# RFTBE 304/GRAFOIL SS 304 SS 304 ASME B16.5 G03GDP11S04 <N/A> (N/A)	1	11654482	1	
BOLTS					
8	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B8M CL2/A194-8MA INCH SIZE I01OB1601 <SB2R58G1/221/2> - 2 NUTS PER BOLT - 65 mm Length	1/2	163801410	4	
VALVES / IN-LINE ITEMS					
9	GATE VALVE API 602 800# A182-F316/316L DUAL GR SWE SWE 12-316&HF API 602 A193-B8M CL2/8MA BB-OS&Y SOW API 602 HW V01GIL1M114N NREQD <G61L-AL021> (L-AL021)	1	13404187	1	

PIPE MATERIAL	NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "~N/A~" MEANS UNICODE IS "NOT AVAILABLE".		
304, dual grade			
HEAT TREATMENT (PWHIT)			
N			
PAINTING SCHEME (3)	NR	CONTRACTOR:	CONTRACTOR DRAWING NUMBER:
PIPING CLASS	6C4		4274-XH-DL-2121IA91F0N-1
WELDING CLASS (4)	M		
PED CATEGORY	Art 4.3		
INSULATION CODE / THK. (mm)	N 0	ANNEX 19	SPEC. L
DRAWING NUMBER 19-000-2-02-00001 sheet 2121IA91F0N-1			REV. 00