



THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 22-12-2022 11:41:35 STREAM NO.: 3278 STREAM REV. NO. : 7 REV. CAUSE ID:

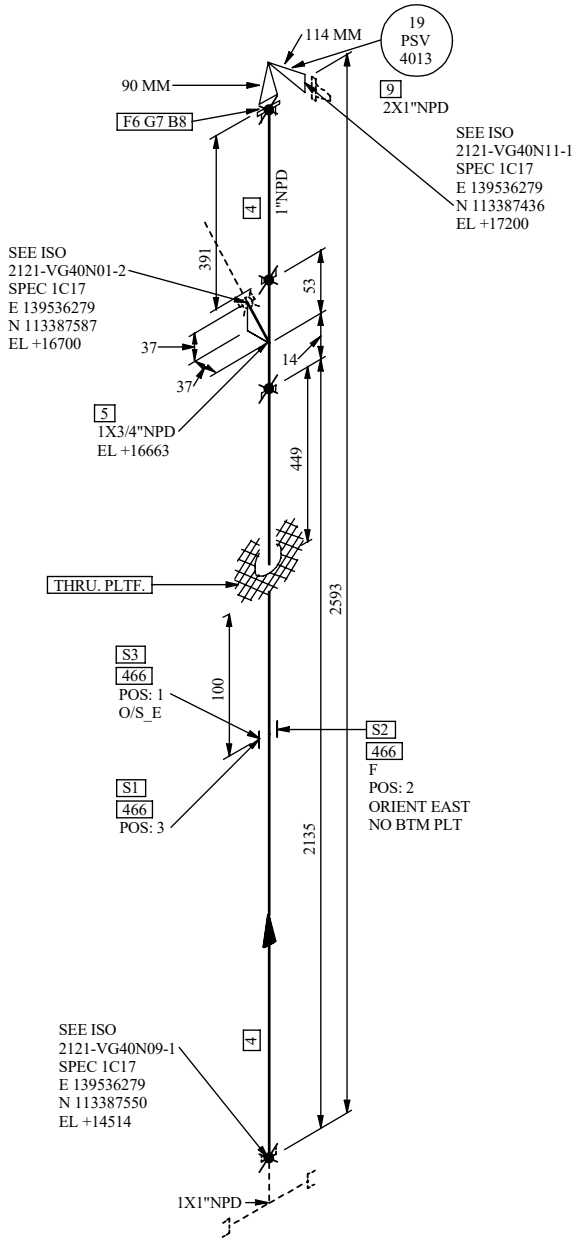

REMARKS FOR MECHANICAL SUBCONTRACTOR:
1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:  DENOTES PARTS LIST NO  PIPE SUPPORT  A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD
WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID 19-A-19-000-1-01-00001 sheet 44
00	ISSUED FOR CONSTRUCTION	23-DEC-22	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86196 sheet 5

APPROVED FOR
CONSTRUCTION

Signature for construction is shown
on Iso list of relevant CWA

ISOMETRIC DRAWING
LINE

2"-VG-40N01-1C17

BILL OF MATERIAL					
PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE SUPPORTS					
1	WELDED BRACKET TO STRUCT. SB01 L80X80X10	1	466	1	
2	STOP HORIZ VERT FOR NOT INS. PIPING-N1F1	1	466	1	
3	U BOLT (FOR GUIDE)-P02D	1	466	1	
PIPE					
4	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A11XS> (L-6679).	1	1132793	2.6 M	
FITTINGS					
5	REDUCING 45 LATERAL ASME B16.11/AA 3000# A105N SWE SWE - R18RNC441101 Undefined <LR4A300LB1211> (L-LR403).	1X3/4	163782626	1	
FLANGES					
6	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R351XS> (L-375).	1	14217823	1	
GASKETS					
7	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP11S12 <N/A> (N/A)	1	163508951	1	
BOLTS					
8	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I010B0301 <SB2R51G5/841/4> - 2 NUTS PER BOLT - 110 mm Length	5/8	153437270	4	
INSTRUMENTS					
9	INSTRUMENT COMPONENT	2X1	19-PSV-4013	1	