REV. CAUSE ID:

STREAM REV. NO.: 9

STREAM NO.:3200

REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

DESCRIPTION

DENOTES PARTS LIST NO PIPE SUPPORT —

6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.

ISSUED FOR REFERENCE

2)

ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.

FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT

9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

16-JUN-23

U.CHAVAN

A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

P.VAZE

CHECK BY

G.PAGANONI

APPR. BY

TRESS CALC. No

PIPE LAYOUT Nº

APPR. CLIENT

19-A-19-000-1-01-00001 sheet 110

19-L-19-000-2-00-86196 sheet 2


19-L-19-000-2-00-80602

4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.

(7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.

8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603

REV.

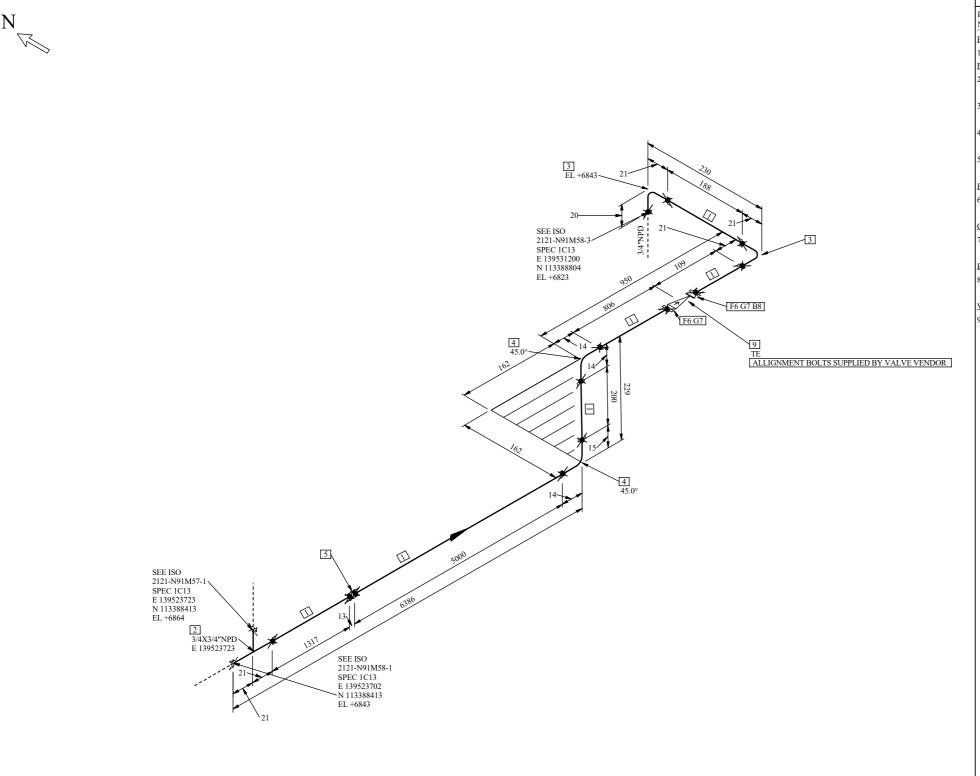

BILL OF MATERIAL NS HOLD COMPONENT DESCRIPTION ITEM CODE QTY (IN) STATUS PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A13/4XS> (L-6679) I132785 FITTINGS TEE ASME B16.11 3000# A105N SWE SWE - R11FNC441101 NREQD < TESA300LBK3/4> 3/4X3/4 I1651300 (L-179) 90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD I1651298 <90FA300LBK3/4> (L-178) 45 ELBOW ASME B16.11 3000# A105N SWE SWE - R32FNC441101 NREQD I1651294 <45FA300LBK3/4> (L-184) COUPLING ASME B16.11 3000# A105N SWE SWE - R01FNC441101 NREOD I1651676 LANGES SW FLANGE ASME B16.5 150# A105N RFFE SWE 125 - 250 AARH F02CDC44B105 S-XS 15378342 <SWFA300R153/4XS>(L-295) SASKETS SPIRAL WOUND GASKET ASME B16.20 150# RFFE 304/PTFE CARBON STEEL SS 304 ASME 3/4 I2230475 B16.5 G03GDB1IG12 < SPAO505R1EA3/4> (L-SPA04) STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I010B0301 153437245 <SB2R51G1/231/2> - 2 NUTS PER BOLT - 90 mm Length ALVES / IN-LINE ITEMS DISC CHECK WFR VALVE ASME B16.34 150# A216-WCB RFTBE 316/R-PTFE, GF 125 -I10016147 250 AARH SL VERTICAL&HORIZONTAL CRACK. PRESS. 1/2 PSI ASME B16.5 V40JDC29P01 NREOD <N/A> (N/A)

REFERENCE
Signature for construction is shown on Iso list of relevant CWA
TITLE

ISSUED FOR

ISOMETRIC DRAWING LINE

3/4"-N-91M58-1C13

PAINTING SCHEME (3) CONTRACTOR:

ANNEX

PIPE MATERIAL

PIPING CLASS

HEAT TREATMENT (PWHT)

INSULATION CODE / THK. (mm)

CS

NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102

3. WELDING ACCORDING TO 45-L-45-000-2-00-80021

CONTRACTOR DRAWING NUMBER:

5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE"

4274-XH-DL-2121N91M58-2 WELDING CLASS (4) LOW LINEAL DENSITY POLYETHILENE (PEL) AND POLYPROPYLENE (PP) PLANTS PED CATEGORY FOR PROJECT - ALBA PROJECT REPSQL Art 4.3

CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX

4001008

PROJECT:

DRAWING NUMBER 00 19-000-2-02-00001 sheet 2121N91M58-2