

THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

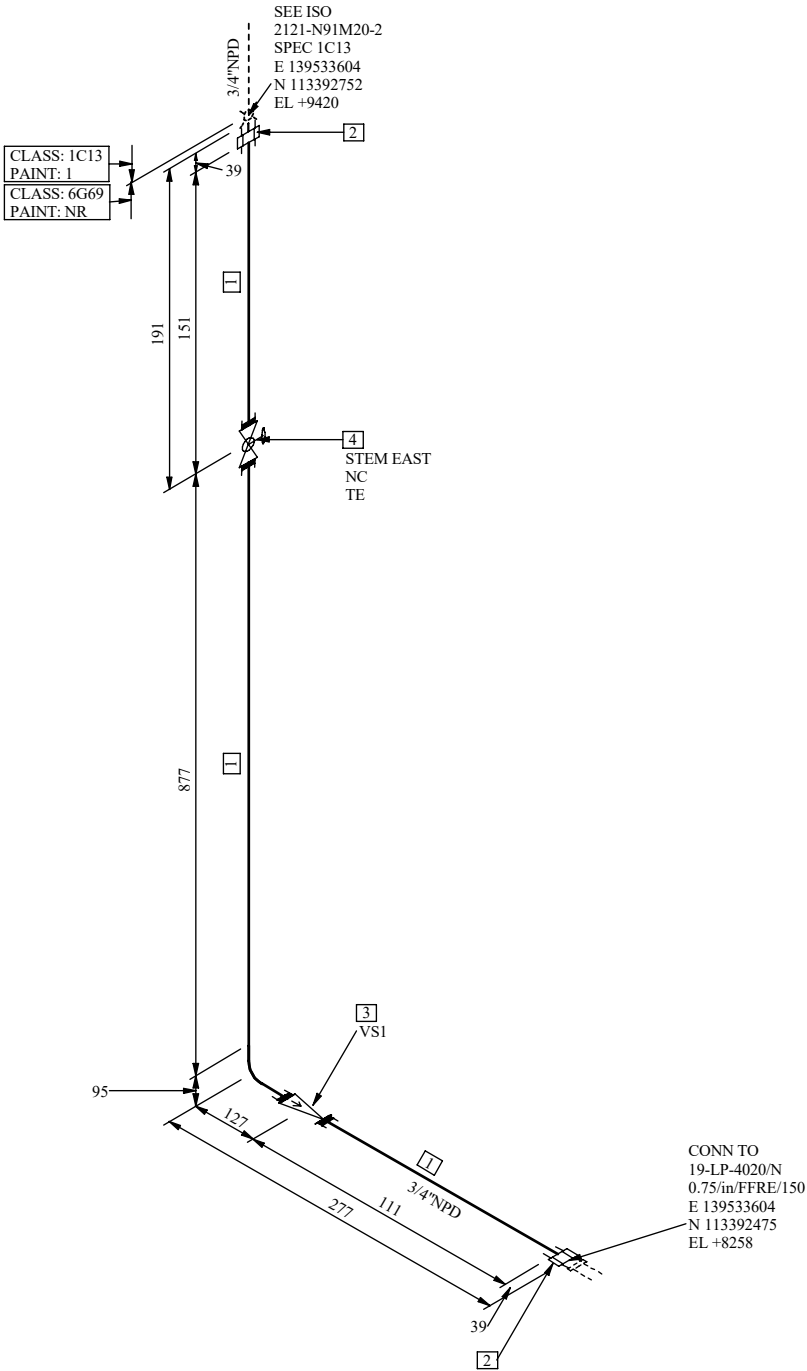


EXTR. DATE: 21-07-2023 08:38:56

STREAM NO.:4900




REV. NO. : 9

REV. CAUSE ID:



REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:  DENOTES PARTS LIST NO PIPE SUPPORT  A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID
							19-A-19-000-1-01-00001 sheet 38
00	ISSUED FOR REFERENCE	21-JUL-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N°
							19-L-19-000-2-00-80602
							PIPE LAYOUT N°
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	19-L-19-000-2-00-86197 sheet 3

ISSUED FOR REFERENCE

Signature for construction is shown on Iso list of relevant CWA


ISOMETRIC DRAWING LINE


3/4"-RSC-40H15-6G69

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	TUBE - A269-TP316/316L-DUAL GRADE PE SMLS T02ALK7Z01 0.095" tubing <N/A> (N/A)	3/4	I65396072	1.2 M	
FITTINGS					
2	COMPR MALE CONNECT MFTR - A182-F316/316L DUAL GR FFRE PE - R60AQL1M7Z10 NREQD <N/A> (N/A)	3/4	I7062336	2	
VALVES / IN-LINE ITEMS					
3	COMPR CHECK VALVE MFTR 6000# A182-F316/316L DUAL GR FFRE FFRE SS316 WITH VITON ORING SEAT POPPET CHECK TYPE SS316/PTFE GASKET NUPRO C/CP SERIES OR EQUAL V49AOL1M7723 NREQD <N/A> (N/A)	3/4	I64875741	1	
4	COMPR BALL VALVE MFTR 6000# A182-F316/316L DUAL GR FFRE FFRE 316-CARBON/GLASS REINFORCED PTFE TRUNNION-MOUNTED OHW V70AOL1M7739 NREQD <N/A> (N/A)	3/4	I65625051	1	

- NOTES:
- 1. FOR TECHNICAL DETAILS SEE LINE LIST.
 - 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102.
 - 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021.
 - 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160.
 - 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".

PAINTING SCHEME (3)	CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
NR		4274-XH-DL-2121RSC40H15-1	4001008

WELDING CLASS (4)	LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT			CLIENT / COMPLEX
-				REPSOL POLYMERS/ SINES INDUSTRIAL COMPLEX

INSULATION CODE / THK. (mm)	ANNEX 19	SPEC. L	DRAWING NUMBER	REV. 00
N 0			19-000-2-02-00001 sheet 2121RSC40H15-1	