

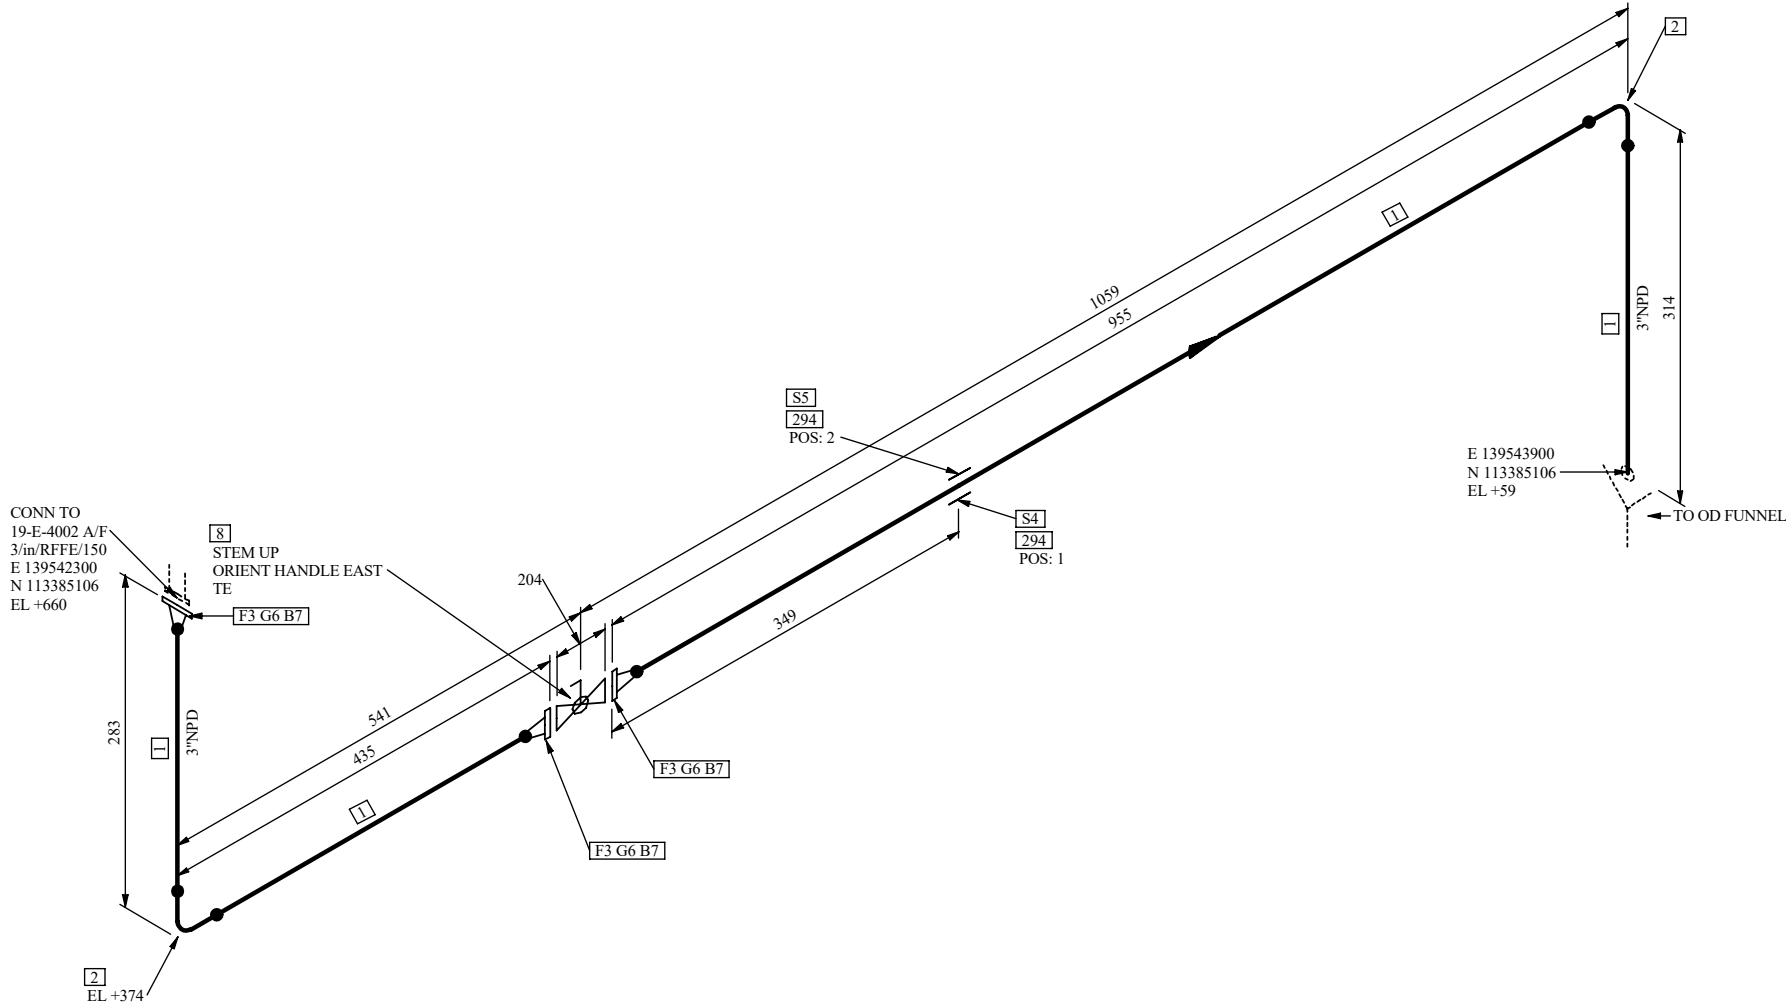
THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 11-11-2022 14:36:23


STREAM NO.:4105





REV. CAUSE ID:

REV. NO. : 6



REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

**SUPPORTS LEGEND:**  DENOTES PARTS LIST NO  PIPE SUPPORT  A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID
							19-A-19-000-1-01-00001 sheet 30
00	ISSUED FOR CONSTRUCTION	11-NOV-22	M.YADAV	P.VAZE	G.PAGANONI		LINE LIST N°
							19-L-19-000-2-00-80602
							PIPE LAYOUT N°
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	19-L-19-000-2-00-86198 sheet 1

APPROVED FOR CONSTRUCTION


Signature for construction is shown on Iso list of relevant CWA

ISOMETRIC DRAWING LINE

3"-CWR-40B05-B-1 (P)

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B BE SMLS T01AC03V02 S-STD <PIPA010B13STD> (L-7806)	3	I117921	1.4 M	
FITTINGS					
2	90 LR ELBOW ASME B16.9 A234-WPB BE SMLS C01DC04V01 S-STD <90LA200F33STD> (L-7955)	3	I128599	2	
FLANGES					
3	WN FLANGE ASME B16.5 150# A105N RFFE BE 125 - 250 AARH F01CDC44BV05 S-STD <WNFA300R153STD> (L-149)	3	I4217820	3	
PIPE SUPPORTS					
4	RESTING SHOE WELDED -C1A1 H= 100 L= 200	3	294	1	
5	STAKES SUPPORTS ST09 L80X80X10	3	294	1	
GASKETS					
6	FLAT RING GASKET ASME B16.21 150# RFTBE NA/ARAMIDIC/NBR ASME B16.5 G02HDP2QR01 <NMGQ009R1FC3> (L-NMG11)	3	I1169032	3	
BOLTS					
7	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G5/831/2> - 2 NUTS PER BOLT - 90 mm Length	5/8	I53437440	12	
VALVES / IN-LINE ITEMS					
8	BALL V-FLT-SS-RB BS EN ISO 17292 150# A216-WCB RFFE 304/R-PTFE, GF B7/2H 125 - 250 AARH 2PSB-RED BORE FLOATING BALL LE ASME B16.5 V1RFDC29B1V NREQD <B43L-AL107> (L-AL107)	3	I2498375	1	

PIPE MATERIAL		NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "~N/A~" MEANS UNICODE IS "NOT AVAILABLE".				
CS						
HEAT TREATMENT (PWHT) N						
PAINTING SCHEME (3) 1		CONTRACTOR: 	CONTRACTOR DRAWING NUMBER: 4274-XH-DL-2121CWR40B05-1	PROJECT: 4001008		
PIPING CLASS B-1						
WELDING CLASS (4) E		LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT				
PED CATEGORY Art 4.3						
INSULATION CODE / THK. (mm) P 50		ANNEX 19	SPEC. L	DRAWING NUMBER 19-000-2-02-00001 sheet 2121CWR40B05-1		REV. 00