


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).


EXTR. DATE: 23-06-2023 10:29:12

STREAM NO.:4557

REV. CAUSE ID:

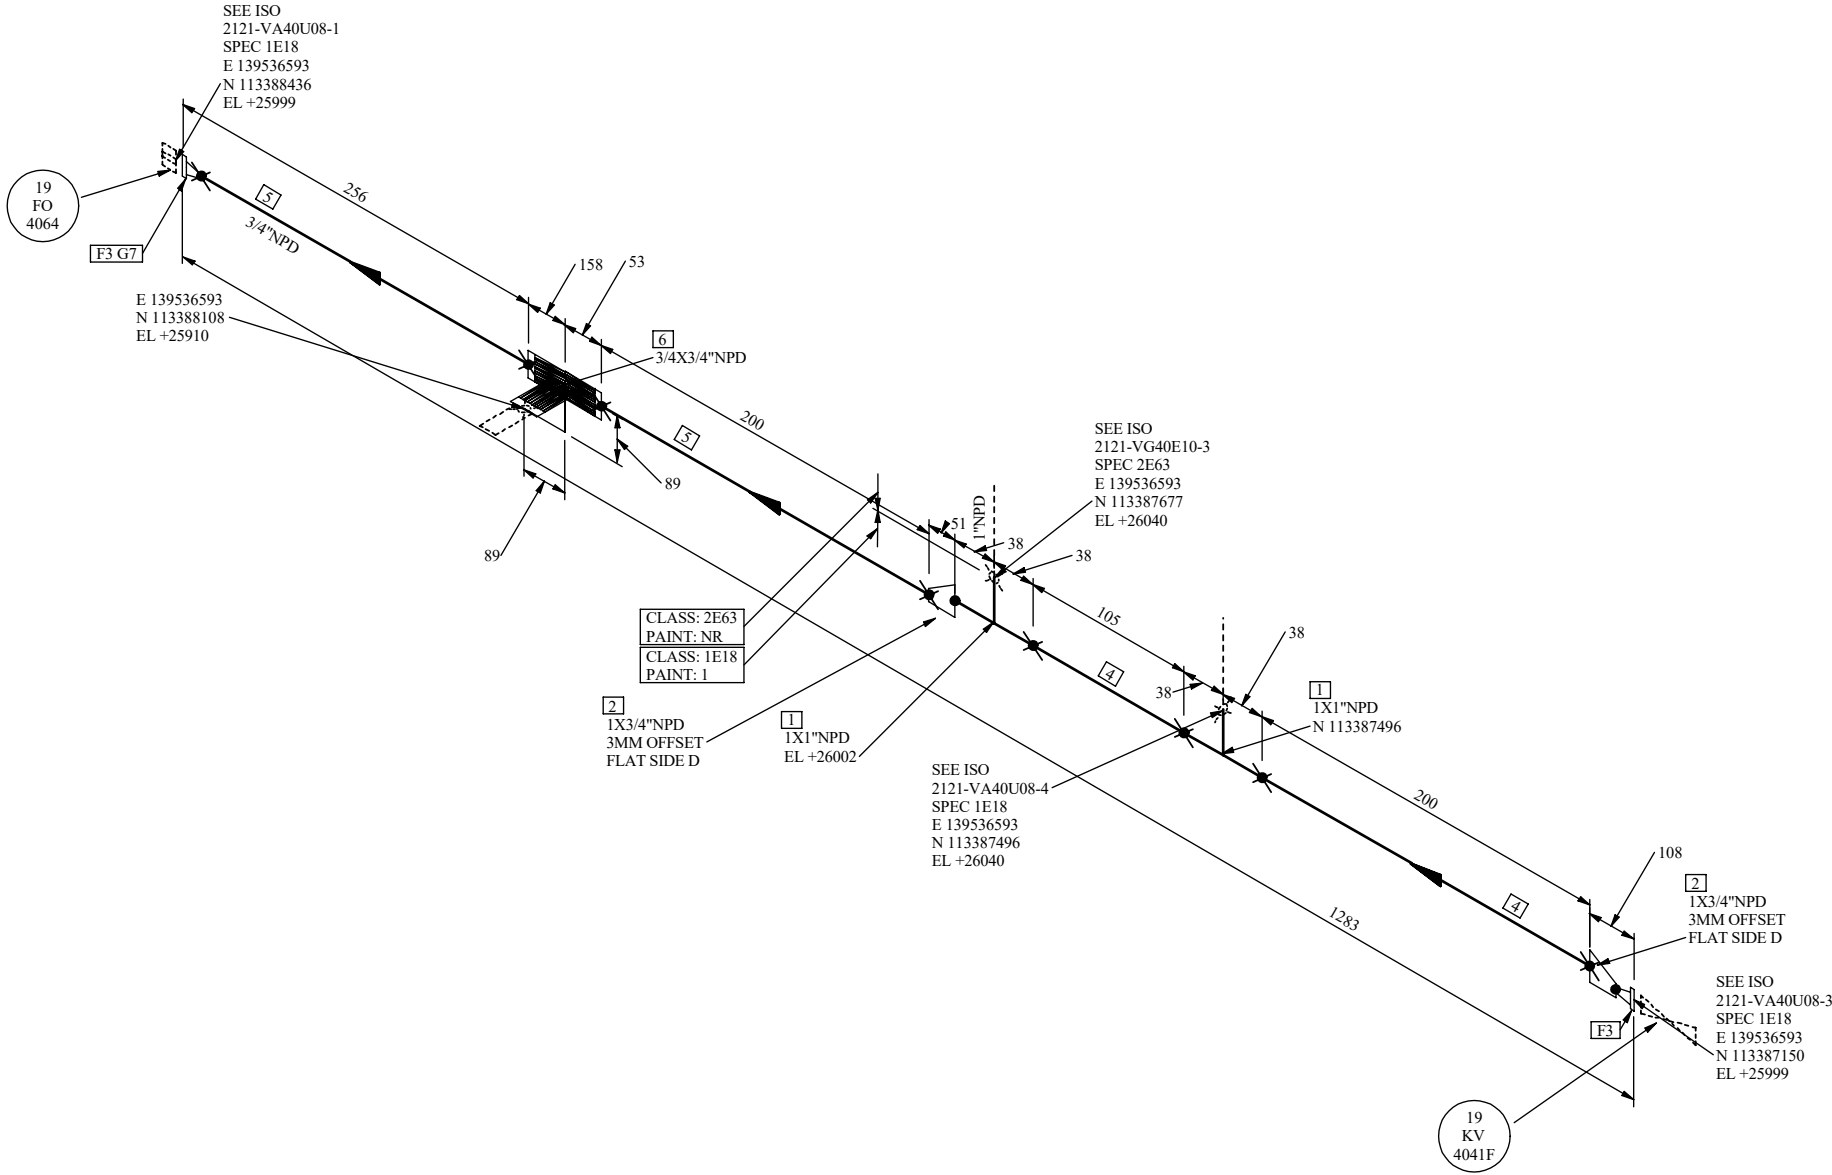

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:  DENOTES PARTS LIST NO  PIPE SUPPORT  A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID
							19-A-19-000-1-01-00001 sheet 49
00	ISSUED FOR REFERENCE	23-JUN-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N°
							19-L-19-000-2-00-80602
							PIPE LAYOUT N°
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	19-L-19-000-2-00-86196 sheet 7

ISSUED FOR
REFERENCE


Signature for construction is shown
on Iso list of relevant CWA

TITLE
ISOMETRIC DRAWING
LINE

1"-VA-40U08-1E18

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
FITTINGS					
1	STRAIGHT TEE ASME B16.9 A234-WPB BE SMLS C31DC04V01 S-XS <TEBA200F312161216> (L-7940)	1X1	1128999	2	
2	ECCENTRIC REDUCER ASME B16.9 A234-WPB BE SMLS C22DC04V01 S-XS S-XS <EREA200F312161116> (L-7938)	1X3/4	1127449	2	
FLANGES					
3	WN FLANGE ASME B16.5 300# A105N RFFE BE 125 - 250 AARH F01CFC44BV05 S-XS <WNFA300R353/4XS> (L-236)	3/4	19805754	2	
PIPE					
4	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A11XS> (L-6679)	1	1132793	0.4 M	
5	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A13/4XS> (L-6679)	3/4	1132785	0.4 M	
FITTINGS					
6	Y-STRAINER BW API 602/AA 600# A105N BE BE 316 SHEET WC Y02LHC44VV5X S-XS <N/A> (N/A)	3/4X3/4	165637107	1	
GASKETS					
7	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP1IS12 <N/A> (N/A)	3/4	163508950	1	

PIPE MATERIAL	NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-800102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".		
CS			
HEAT TREATMENT (PWHIT)			
N			
PAINTING SCHEME (3)			
1	CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
PIPING CLASS		4274-XH-DL-2121VA40U08-2	4001008
1E18	LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT		
WELDING CLASS (4)	CLIENT / COMPLEX		
A-7	REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX		
PED CATEGORY			
Art 4.3			
INSULATION CODE / THK. (mm)	ANNEX 19	SPEC. L	DRAWING NUMBER
N 0			19-000-2-02-00001 sheet 2121VA40U08-2
			REV. 00