
REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603

2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗, ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT

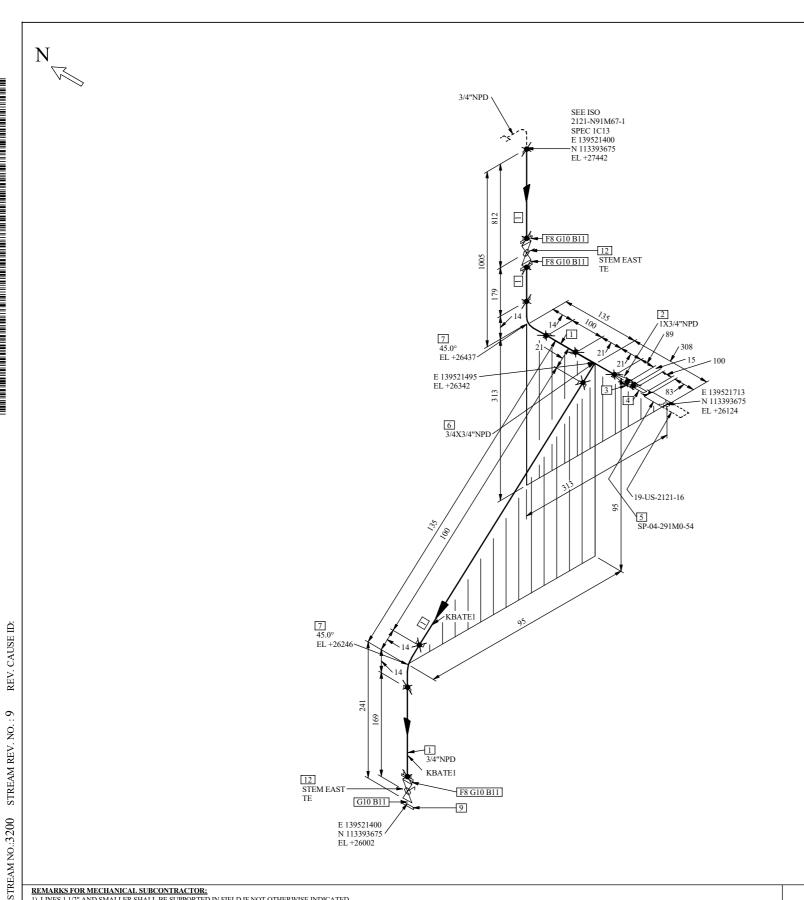

BILL OF MATERIAL HOLD COMPONENT DESCRIPTION ITEM CODE QTY STATUS (IN) PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A13/4XS> (L-6679) I132785 FITTINGS CONCENTRIC SWAGE MSS SP-95 - A105N PE PE SMLS SCH1-XS SCH2-XS R21FQC44ZZ01 1X3/4 I63782569 <CSWA010AR12161116> (L-7890) I1651677 COUPLING ASME B16.11 3000# A105N SWE SWE - R01FNC441101 NREQD <FCPA300LBK1>(L-180) NIPPLE - - A106-B PE MTE SMLS LENGTH 100mm R03AQC03ZW04 S-XS I2221194 <NTOA010E1121624> (L-7888) SP-04-291M0-54 1 SPECIALTY COMPONENT TEE ASME B16.11 3000# A105N SWE SWE - R11FNC441101 NREQD <TESA300LBK3/4> I1651300 45 ELBOW ASME B16.11 3000# A105N SWE SWE - R32FNC441101 NREQD I1651294 <45FA300LBK3/4> (L-184) LANGES SW FLANGE ASME B16.5 150# A105N RFFE SWE 125 - 250 AARH F02CDC44B105 S-XS 15378342 <SWFA300R153/4XS> (L-295) BLIND FLANGE ASME B16.5 150# A105N RFFE NREQD 125 - 250 AARH F10CDC44B005 I1652356 <BLFA300R153/4> (L-140) 0 SPIRAL WOUND GASKET ASME B16.20 150# RFFE 304/PTFE CARBON STEEL SS 304 ASME 3/4 12230475 B16.5 G03GDB1IG12 < SPAQ505R1EA3/4> (L-SPA04) 11 STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE 1010B0301 153437190 <SB2R51G1/221/2> - 2 NUTS PER BOLT - 65 mm Length VALVES / IN-LINE ITEMS 2 BALL VALVE API 608 150# A216-WCB RFFE 316/R-PTFE, GF B7/2H 125 - 250 AARH I10013686 2PSB-FULL BORE FLOATING BALL OHW ASME B16.5 V04JDC29BZZG NREQD <N/A> (N/A)

5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002. 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED. 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN. 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603). 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274-NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.	Signature for
SUPPORTS LEGEND: DENOTES PARTS LIST NO SUPPORT — A RESTING SUPPORT G = GLIDE F = AXIAL STOP B = ANCHOR M = SPRING S = TIFL ON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.	Signature for on Iso list
STRESS CALC. N° TII	ITLE
P & ID 19-A-19-000-1-01-00001 sheet 110	ISOMET
LINE LIST N°	
00 ISSUED FOR REFERENCE 02-JUN-23 U.CHAVAN P.VAZE G.PAGANONI 19-L-19-000-2-00-80602	
REV. DESCRIPTION DATE DRW. BY CHECK BY APPR. BY APPR. CLIENT PIPE LAYOUT N° 19-L-19-000-2-00-86197 sheet 7	1"-N-91M

REFERENCE or construction is shown ist of relevant CWA

**ISSUED FOR** 

TRIC DRAWING PED CATEGORY LINE INSULATION CODE / THK. (mm) M67-1C13

PIPE MATERIAL

HEAT TREATMENT (PWHT)

Art 4.3

CS

NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102

3. WELDING ACCORDING TO 45-L-45-000-2-00-80021

5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE" PAINTING SCHEME (3) CONTRACTOR: CONTRACTOR DRAWING NUMBER: PROJECT:

PIPING CLASS 4001008 4274-XH-DL-2121N91M67-2 WELDING CLASS (4) LOW LINEAL DENSITY POLYETHILENE (PEL)

CLIENT / COMPLEX AND POLYPROPYLENE (PP) PLANTS REPSOL POLYMEROS/ FOR PROJECT - ALBA PROJECT

SINES INDUSTRIAL COMPLEX REPSQL DRAWING NUMBER ANNEX 00 19-000-2-02-00001 sheet 2121N91M67-2