REV.

SUPPORTS LEGEND:

ISSUED FOR REFERENCE

ISSUED FOR REFERENCE

REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

DESCRIPTION

DENOTES PARTS LIST NO PIPE SUPPORT —


2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.

3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗, ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT

4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.

6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.

8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603

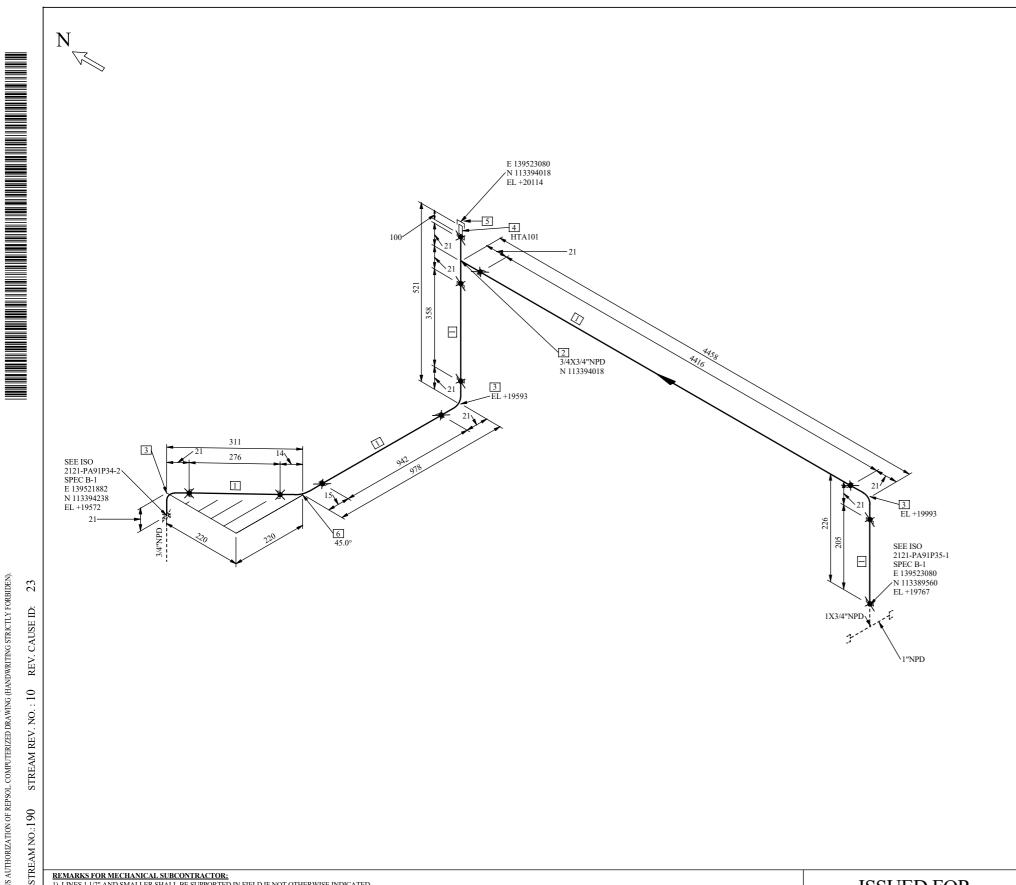

A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

P.VAZE

P.VAZE

CHECK BY

G.PAGANONI

G.PAGANONI

APPR. BY

M.YADAV

U.CHAVAN

09-FEB-24

09-JUN-23

TRESS CALC. Nº

PIPE LAYOUT Nº

APPR. CLIENT

19-A-19-000-1-01-00001 sheet 112

19-L-19-000-2-00-86197 sheet 5

19-L-19-000-2-00-80602

HOLD N.S. COMPONENT DESCRIPTION ITEM CODE STATUS QTY (IN) PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A13/4XS> (L-6679) I132785 FITTINGS TEE ASME B16.11 3000# A105N SWE SWE - R11FNC441101 NREQD <TESA300LBK3/4> 3/4X3/4 I1651300 (L-179) 90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD I1651298 <90FA300LBK3/4> (L-178) NIPPLE - - A106-B PE MTE SMLS LENGTH 100mm R03AQC03ZW04 S-XS 12221184 <NTOA010E1111624> (L-7888) CAP ASME B16.11 3000# A105N FTE NREQD - R41FNC442001 NREQD <CATA300KBK3/4> 3/4 11651686 45 ELBOW ASME B16.11 3000# A105N SWE SWE - R32FNC441101 NREQD I1651294 PIPE MATERIAL NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102 CS 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021 HEAT TREATMENT (PWHT) 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE" PAINTING SCHEME (3) CONTRACTOR: CONTRACTOR DRAWING NUMBER: PROJECT: PIPING CLASS 4001008 4274-XH-DL-2121PA91P34-1 WELDING CLASS (4) LOW LINEAL DENSITY POLYETHILENE (PEL) CLIENT / COMPLEX AND POLYPROPYLENE (PP) PLANTS ISOMETRIC DRAWING REPSOL POLYMEROS/ PED CATEGORY FOR PROJECT - ALBA PROJECT SINES INDUSTRIAL COMPLEX REPSQL Art 4.3 INSULATION CODE / THK. (mm) DRAWING NUMBER ANNEX 01 19-000-2-02-00001 sheet 2121PA91P34-1

ISSUED FOR

REFERENCE

Signature for construction is shown

on Iso list of relevant CWA

LINE

3/4"-PA-91P34-B-1

BILL OF MATERIAL