
REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

2)

ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.

FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT

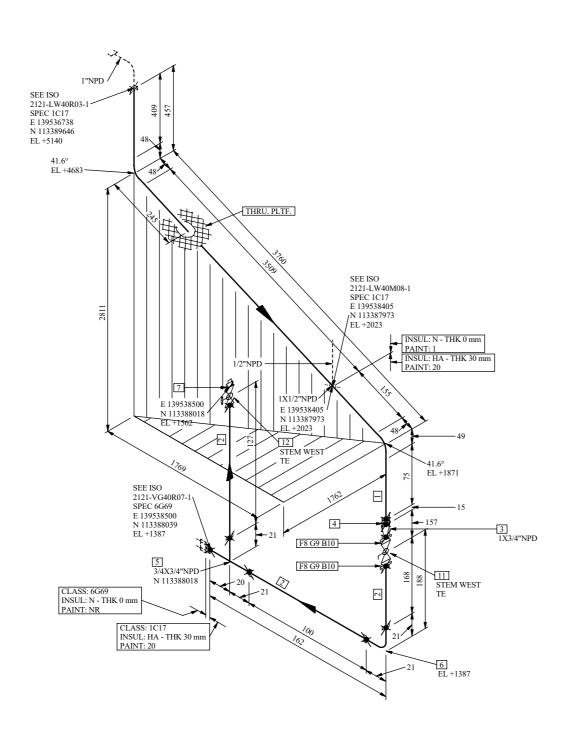

BILL OF MATERIAL HOLD COMPONENT DESCRIPTION STATUS ITEM CODE QTY (IN) PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A11XS > (L-6679) I132793 4.4 M PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A13/4XS > (L-6679) I132785 0.3 M CONCENTRIC SWAGE MSS SP-95 - A105N PE PE SMLS SCH1-XS SCH2-XS R21FQC44ZZ01 1X3/4 163782569 COUPLING ASME B16.11 3000# A105N SWE SWE - R01FNC441101 NREOD 11651677 <FCPA300LBK1> (L-180) TEE ASME B16.11 3000# A105N SWE SWE - R11FNC441101 NREQD <TESA300LBK3/4> 3/4X3/4 I1651300 90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD I1651298 < 90FA300LBK3/4>(L-178) PLUG ROUND HEAD ASME B16.11 - A105N MTE NREQD - R42FQC44W001 NREQD I10088232 <PLUA300CK3/4> (L-77) LANGES SW FLANGE ASME B16.5 150# A105N RFFE SWE 125 - 250 AARH F02CDC44B105 S-XS 15378342 <SWFA300R153/4XS> (L-295) SPIRAL WOUND GASKET ASME B16.20 150# RFTBE 304/GRAFOIL CARBON STEEL SS 304 3/4 163508895 ASME B16.5 G03GDP1IS12 <N/A> (N/A) 0 STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I010B0301 153437190 <SB2R51G1/221/2> - 2 NUTS PER BOLT - 65 mm Length VALVES / IN-LINE ITEMS BALL VALVE API 608 150# A216-WCB RFFE 316/R-PTFE, GF B7/2H 125 - 250 AARH I10013686 2PSR-FULL BORE FLOATING BALL OHW ASME B16.5 V04IDC29BZZG NRFOD <N/A> (N/A) BALL VALVE ASME B16.34 800# A105N SWE FTE 316/R-PTFE, GF 3PSB-RED BORE 166567923 FLOATING BALL OHW FIRE SAFE :API 607 & ANTISTATIC DEVICES "A60T series" TEAL V04JIC44126IG NREQD <N/A> (N/A)

13:33:03	5) GUS 6) CRC 7) IN C 8) ACT	FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603. GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002. CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED. IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN. ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF. TO 4274-LZ-PC-00000603). WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274-NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.							
SUPPORTS LEGEND: DENOTES PARTS LIST NO PIPE — A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.									
78-1 <i>7</i>								STRESS CALC. Nº	
Э Э	01	ISSUED FOR REFERENCE	24-NOV-23	M.YADAV	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 46	
. DAI	00	ISSUED FOR REFERENCE	04-SEP-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602	
EXIR	REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT № 19-L-19-000-2-00-86196 sheet 1	

REFERENCE Signature for construction is shown on Iso list of relevant CWA

ISSUED FOR

PIPE MATERIAL

PIPING CLASS

WELDING CLASS (4)

INSULATION CODE / THK. (mm)

PED CATEGORY

HEAT TREATMENT (PWHT)

1C17

ANNEX

CS

ISOMETRIC DRAWING LINE 1"-LW-40R03-1C17 (HA)

NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.

2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102

3. WELDING ACCORDING TO 45-L-45-000-2-00-80021

4274-XH-DL-2121LW40R03-2

5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE" PAINTING SCHEME (3) CONTRACTOR: CONTRACTOR DRAWING NUMBER: PROJECT:

> LOW LINEAL DENSITY POLYETHILENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT REPSQL Art 4.3

CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX

4001008

DRAWING NUMBER 01 19-000-2-02-00001 sheet 2121LW40R03-2