


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).




EXTR. DATE: 18-04-2023 11:14:15

STREAM NO.: 74

STREAM REV. NO. : 7

REV. CAUSE ID:

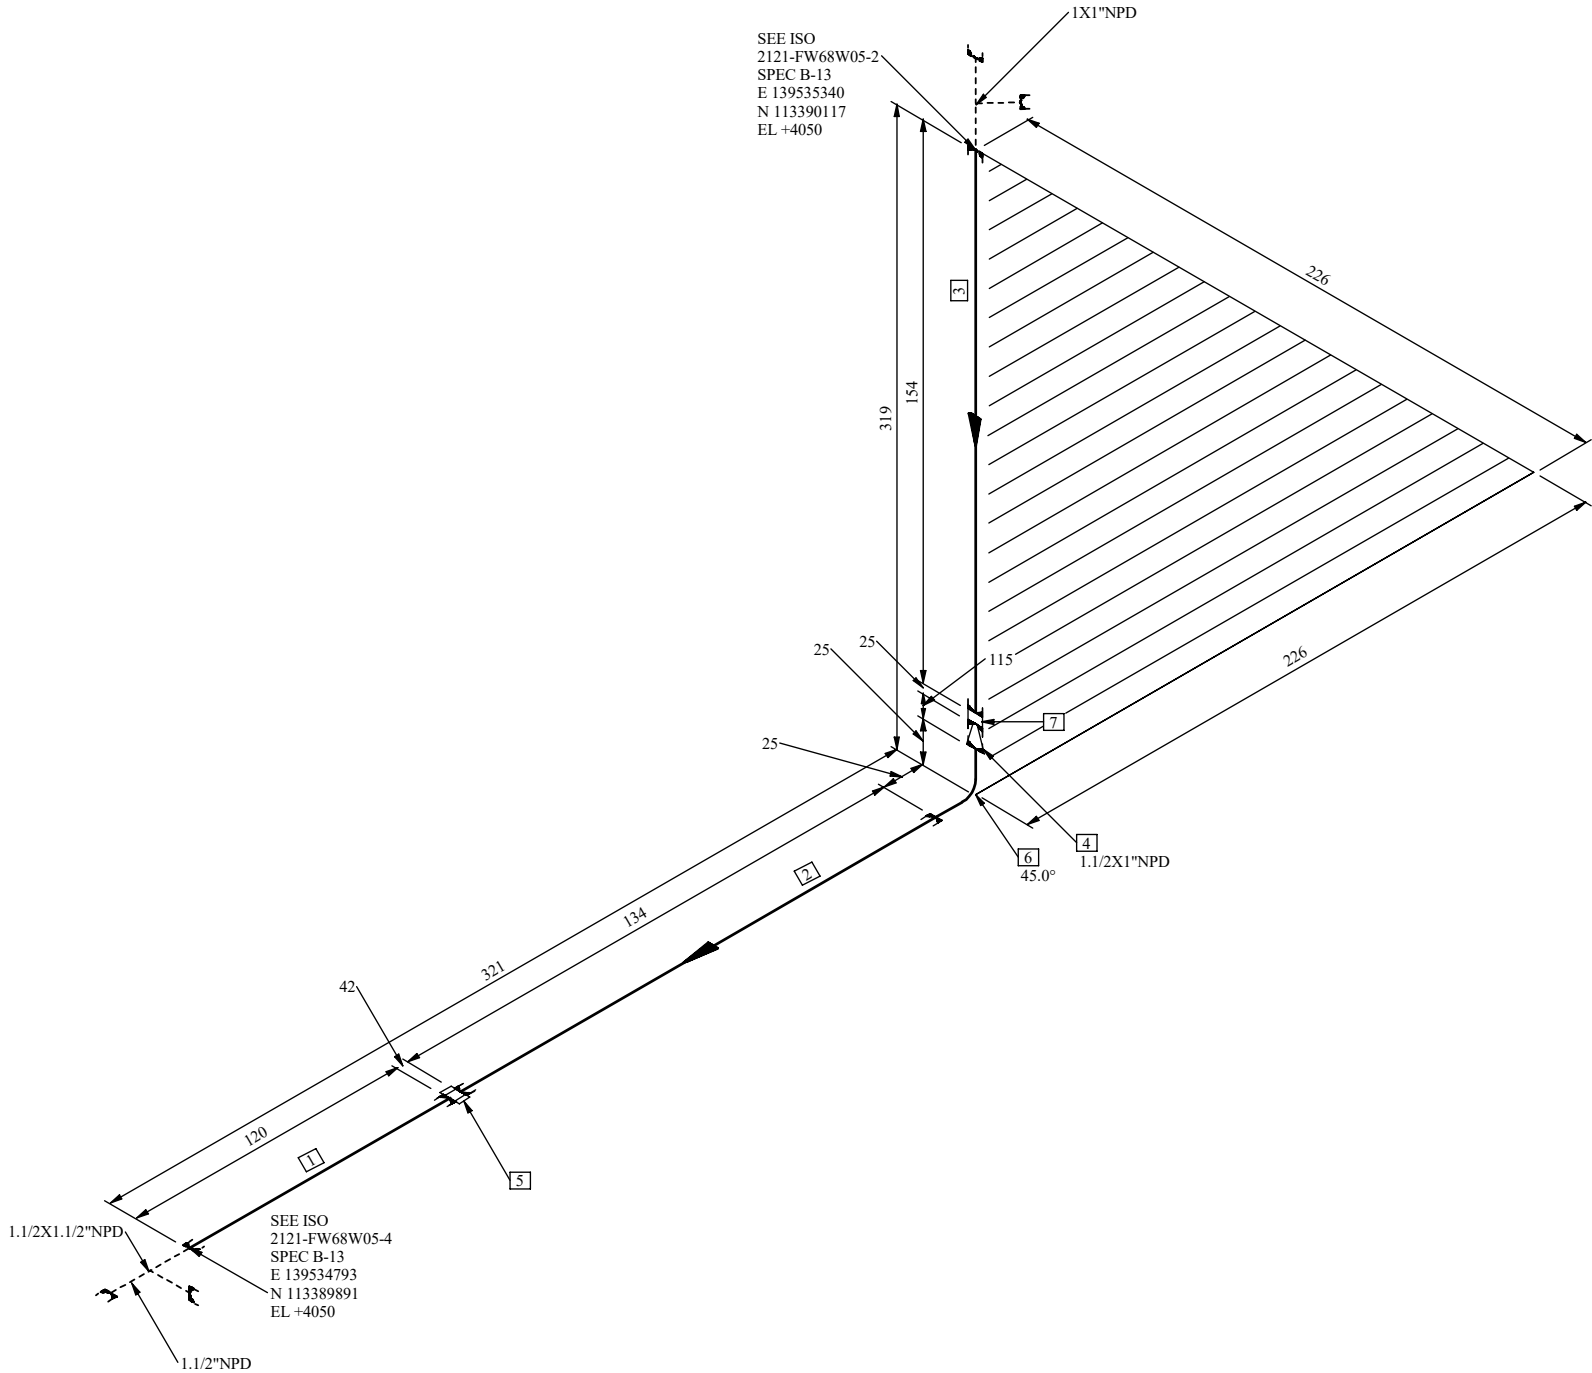





SEE ISO
2121-FW68W05-2
SPEC B-13
E 139535340
N 113390117
EL +4050

SEE ISO
2121-FW68W05-4
SPEC B-13
E 139534793
N 113389891
EL +4050

1X1"NPD
1.1/2X1.1/2"NPD
45.0°

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL  , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:  DENOTES PARTS LIST NO PIPE SUPPORT  A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N° -
							P & ID 19-A-19-000-1-01-00001 sheet 124
00	ISSUED FOR REFERENCE	21-APR-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86197 sheet 2

ISSUED FOR
REFERENCE

Signature for construction is shown
on Iso list of relevant CWA


TITLE
**ISOMETRIC DRAWING
LINE**

1-1/2"-FW-68W05-B-13

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A53-B GALV MTE SMLS T01AC11W02 S-XS <PIPG010C111/2XS> (N/A)	1.1/2	I145610	0.2 M	
2	PIPE - A53-B GALV MTE SMLS T01AC11W02 S-XS <PIPG010C111/2XS> (N/A).	1.1/2	I145610	0.2 M	
3	PIPE - A53-B GALV MTE SMLS T01AC11W02 S-XS <PIPG010C11XS> (N/A)	1	I145594	0.2 M	
FITTINGS					
4	CONCENTRIC SWAGE MSS SP-95 - A105 GALV MTE MTE SMLS SCH1-XS SCH2-XS R21FQC02WW01 <CSWG010DR13161216> (L-CSW28)	1.1/2X1	I4264798	1	
5	UNION ASME B16.11 3000# A105 GALV FTE FTE - R43FNC022201 NREQD <N/A> (N/A)	1.1/2	I45867362	1	
6	45 ELBOW ASME B16.11 3000# A105 GALV FTE FTE - R32FNC022201 NREQD <45TG300KBK11/2> (L-8908)	1.1/2	I214934	1	
7	COUPLING ASME B16.11 3000# A105 GALV FTE FTE - R01FNC022201 NREQD <FCPG300KBK1> (L-8910)	1	I214897	1	

- NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.
2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102.
3. WELDING ACCORDING TO 45-L-45-000-2-00-80021.
4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160.
5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".

CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
	4274-XH-DL-2121FW68W05-3	4001008

LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS CLIENT / COMPLEX
FOR PROJECT - ALBA PROJECT REPSOL POLYMEROS/
SINES INDUSTRIAL COMPLEX

ANNEX 19	SPEC. L	DRAWING NUMBER 19-000-2-02-00001 sheet 2121FW68W05-3	REV. 00
-------------	------------	---	-------------------