
REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

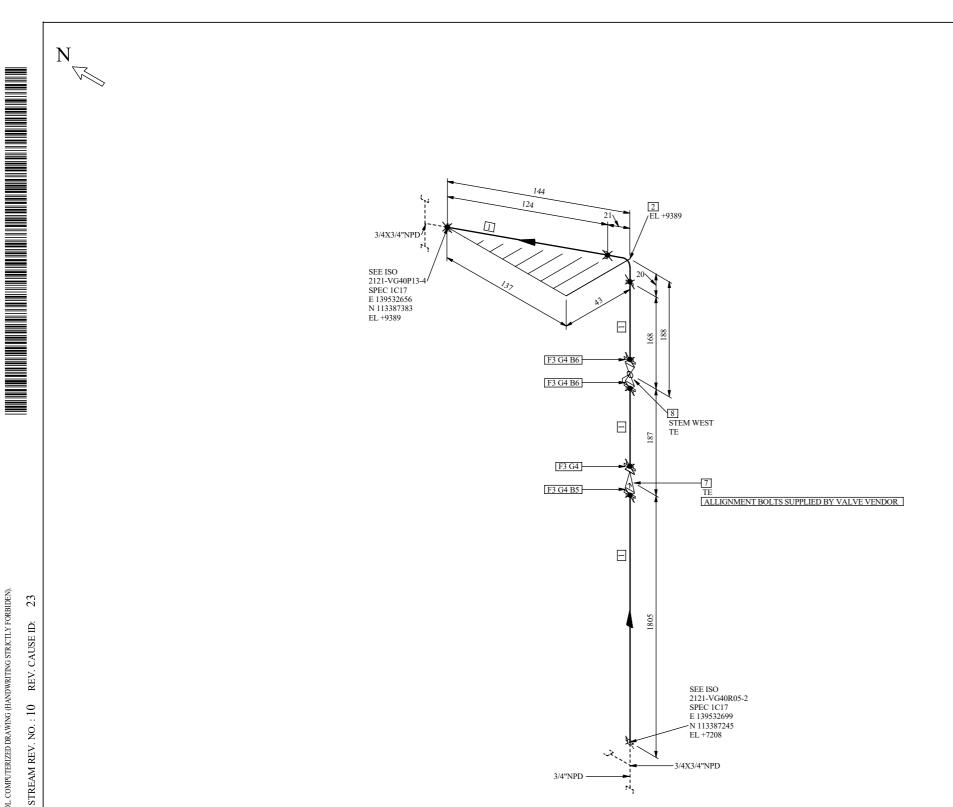

BILL OF MATERIAL HOLD N.S. COMPONENT DESCRIPTION ITEM CODE QTY STATUS (IN) PIPE PIPE - A106-B PE SMLS T01AC03Z02 S-XS < PIPA010A13/4XS> (L-6679) I132785 FITTINGS 90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD I1651298 <90FA300LBK3/4> (L-178) FLANGES SW FLANGE ASME B16.5 150# A105N RFFE SWE 125 - 250 AARH F02CDC44B105 S-XS 15378342 <SWFA300R153/4XS> (L-295) SASKETS SPIRAL WOUND GASKET ASME B16.20 150# RFTBE 304/GRAFOIL CARBON STEEL SS 304 3/4 163508895 ASME B16.5 G03GDP1IS12 <N/A> (N/A) I53437245 STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I010B0301 <SB2R51G1/231/2> - 2 NUTS PER BOLT - 90 mm Length STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I010B0301 I53437190 <SB2R51G1/221/2> - 2 NUTS PER BOLT - 65 mm Length VALVES / IN-LINE ITEMS DISC CHECK WFR VALVE ASME B16.34 150# A216-WCB RFTBE 316/R-PTFE, GF 125 -I10016147 250 AARH SL VERTICAL&HORIZONTAL CRACK. PRESS. 1/2 PSI ASME B16.5 V40JDC29P01 NREQD <N/A> (N/A) BALL VALVE API 608 150# A216-WCB RFFE 316/R-PTFE, GF B7/2H 125 - 250 AARH 3/4 I10013686 2PSB-FULL BORE FLOATING BALL OHW ASME B16.5 V04JDC29BZZG NREQD <N/A> (N/A)

3	 LINES I.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED. ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗, ONE WELD FO FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-0000603. GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2 	BE CHECKED IN I	OF IN LINE COM					REFEREN
6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED. 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN. 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF. TO 4274-LZ-PC-00000603). 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.							Signature for construction	
SUPPORTS LEGEND: DENOTES PARTS LIST NO SUPPORT — A-RESTING SUPPORT G-GUIDE F-AXIAL STOP B-ANCHOR M-STRING S-TEFLON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.								on Iso list of relevan
							STRESS CALC. Nº	ISOMETRIC DR
01	I ISSUED FOR REFERENCE	15-DEC-23	M.YADAV	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 46	
00	00 ISSUED FOR REFERENCE	05-MAY-2023	M.YADAV	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602	LINE
	REV. DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86196 sheet 3	3/4"-VG-40R05-1C17

RENCE truction is shown elevant CWA

ISSUED FOR

DRAWING

PAINTING SCHEME (3) CONTRACTOR: PIPING CLASS 1C17

INSULATION CODE / THK. (mm)

Art 4.3

ANNEX

PIPE MATERIAL

HEAT TREATMENT (PWHT)

CS

NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.

2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102

3. WELDING ACCORDING TO 45-L-45-000-2-00-80021

5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE"

19-000-2-02-00001 sheet 2121VG40R05-3

CONTRACTOR DRAWING NUMBER:

4001008 4274-XH-DL-2121VG40R05-3 WELDING CLASS (4) LOW LINEAL DENSITY POLYETHILENE (PEL) PED CATEGORY

AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT REPSQL

DRAWING NUMBER

CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX

01

PROJECT:

FILENAME: 19-000-2-02-00001 sheet 2121VG40R05-3.dwg