


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 16-12-2023 13:25:26

STREAM NO.:4552 STREAM REV. NO. : 10 REV. CAUSE ID: 23

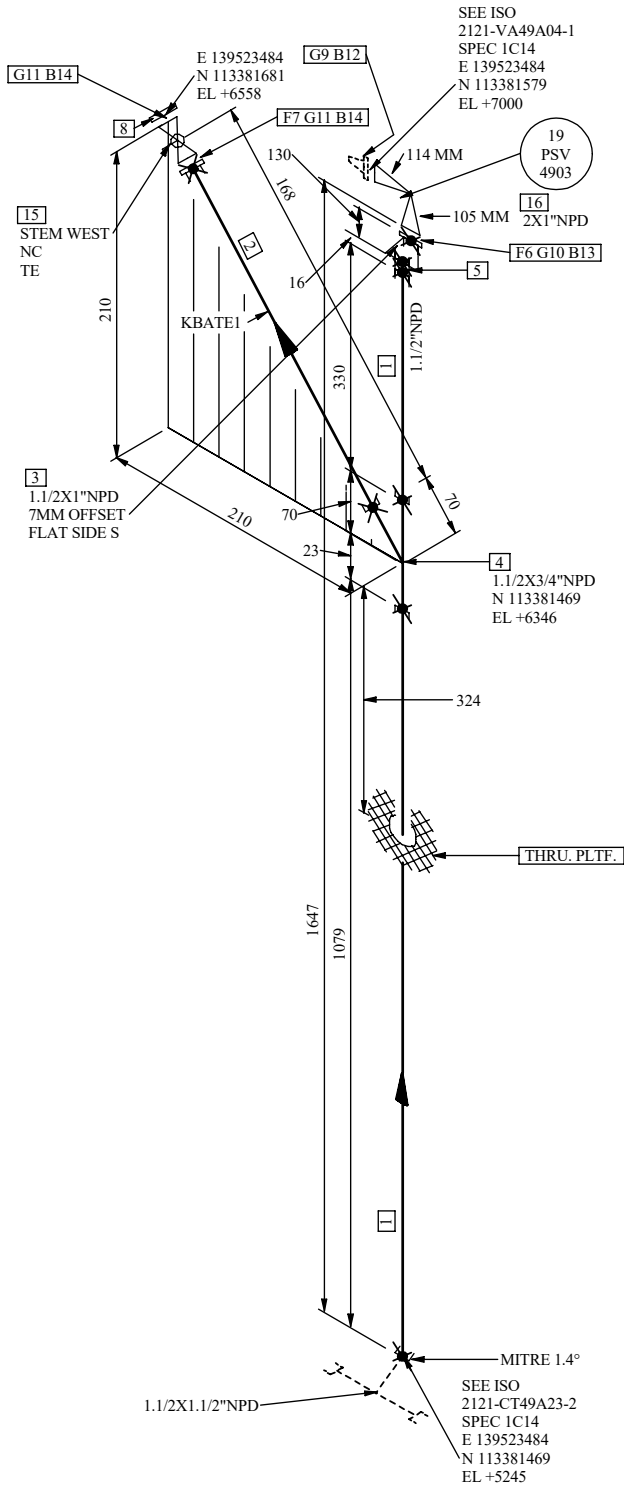

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✕ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND: [] DENOTES PARTS LIST NO PIPE SUPPORT A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD
WHERE [] WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N° -
01	ISSUED FOR CONSTRUCTION	16-DEC-23	U.CHAVAN	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 57
00	ISSUED FOR CONSTRUCTION	24-FEB-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86196 sheet 2

APPROVED FOR
CONSTRUCTION



Signature for construction is shown
on Iso list of relevant CWA

TITLE
**ISOMETRIC DRAWING
LINE**

2"-CT-49A15-1C14

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A111/2XS> (L-6679)	1.1/2	I132809	1.5 M	
2	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A13/4XS> (L-6679)	3/4	I132785	0.1 M	
FITTINGS					
3	ECCENTRIC SWAGE MSS SP-95 - A105N PE PE SMLS SCH1-XS SCH2-XS R22FQC44ZZ01 <ESWA010AR13161216> (L-ESW31).	1.1/2X1	162946435	1	
4	REDUCING 45 LATERAL ASME B16.11/AA 3000# A105N SWE SWE - R18RNC441101 Undefined <LR4A300LB1311> (L-LR403)	1.1/2X3/4	163782637	1	
5	COUPLING ASME B16.11 3000# A105N SWE SWE - R01FNC441101 NREQD <FCPA300LBK11/2> (L-180)	1.1/2	I1651679	1	
FLANGES					
6	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R351XS> (L-375)	1	I4217823	1	
7	SW FLANGE ASME B16.5 150# A105N RFFE SWE 125 - 250 AARH F02CDC44B105 S-XS <SWFA300R153/4XS> (L-295)	3/4	I5378342	1	
8	BLIND FLANGE ASME B16.5 150# A105N RFFE NREQD 125 - 250 AARH F10CDC44B005 <BLFA300R153/4> (L-140)	3/4	I1652356	1	
GASKETS					
9	SPIRAL WOUND GASKET ASME B16.20 150# RFFE 304/PTFE CARBON STEEL SS 304 ASME B16.5 G03GDBI1G12 <SPAQ505R1EA2> (L-SPA04)	2	I2230484	1	
10	SPIRAL WOUND GASKET ASME B16.20 300# RFFE 304/PTFE CARBON STEEL SS 304 ASME B16.5 G03GFB11G12 <SPAQ505R3EA1> (L-SPA05)	1	I63598746	1	
11	SPIRAL WOUND GASKET ASME B16.20 150# RFFE 304/PTFE CARBON STEEL SS 304 ASME B16.5 G03GDBI1G12 <SPAQ505R1EA3/4> (L-SPA04)	3/4	I2230475	2	
BOLTS					
12	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G5/831/2> - 2 NUTS PER BOLT - 85 mm Length	5/8	I53437429	4	
13	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G5/841/4> - 2 NUTS PER BOLT - 110 mm Length	5/8	I53437270	4	
14	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G1/221/2> - 2 NUTS PER BOLT - 65 mm Length	1/2	I53437190	8	
VALVES / IN-LINE ITEMS					
15	BALL VALVE API 608 150# A216-WCB RFFE 316/R-PTFE, GF B7/2H 125 - 250 AARH 2PSB-FULL BORE FLOATING BALL OHW ASME B16.5 V04JDC29BZZG NREQD <N/A> (N/A)	3/4	I10013686	1	
INSTRUMENTS					
16	INSTRUMENT COMPONENT	2X1	I9-PSV-4903	1	

PIPE MATERIAL		<div>NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.</div> <div>2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102.</div> <div>3. WELDING ACCORDING TO 45-L-45-000-2-00-80021.</div> <div>4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160.</div> <div>5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".</div>							
CS									
HEAT TREATMENT (PWHT)									
N									
PAINTING SCHEME (3)		<div>CONTRACTOR:</div> <div></div>		<div>CONTRACTOR DRAWING NUMBER:</div> <div>4274-XH-DL-2121CT49A15-1</div>		<div>PROJECT:</div> <div>4001008</div>			
1									
PIPING CLASS									
IC14									
WELDING CLASS (4)		<div>LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS</div> <div>FOR PROJECT - ALBA PROJECT</div> <div></div> <div>CLIENT / COMPLEX</div> <div>REPSOL POLYMEROS/</div> <div>SINES INDUSTRIAL COMPLEX</div>							
E-2									
PED CATEGORY									
I									
INSULATION CODE / THK. (mm)		<div>ANNEX</div> <div>19</div>		<div>SPEC.</div> <div>L</div>		<div>DRAWING NUMBER</div> <div>19-000-2-02-00001 sheet 2121CT49A15-1</div>		<div>REV.</div> <div>01</div>	
N 0									