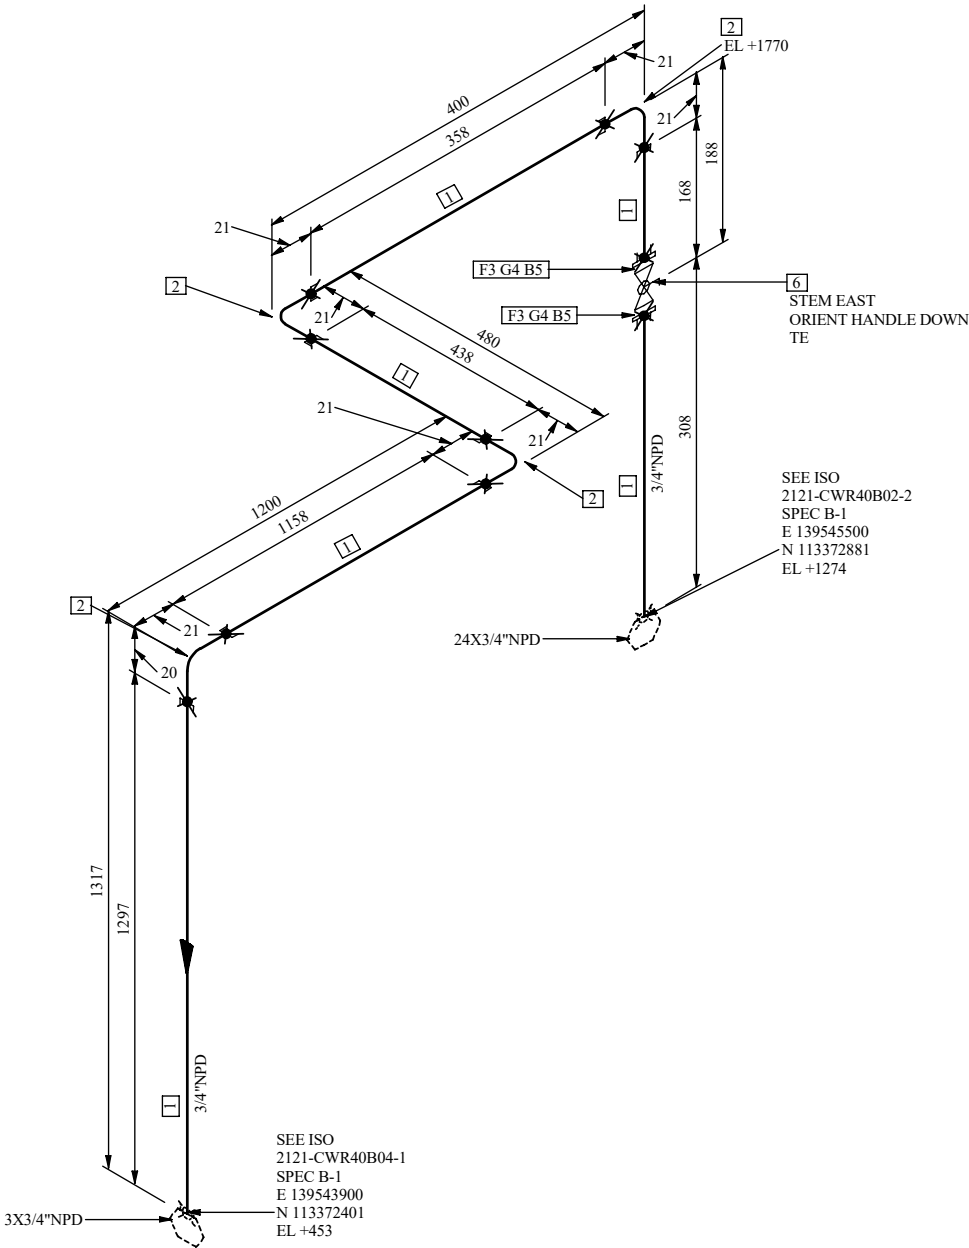


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).


EXTR. DATE: 28-04-2023 16:54:58





STREAM NO.:4105

REV. CAUSE ID:



REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:	 DENOTES PARTS LIST NO	 PIPE SUPPORT	 A=RESTING SUPPORT WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.	G=GUIDE	F=AXIAL STOP	B=ANCHOR	M=SPRING	S=TEFLON PAD
------------------	---	--	--	---------	--------------	----------	----------	--------------

							STRESS CALC. N°
							REP-PE-008
							P & ID
							19-A-19-000-1-01-00001 sheet 37
							LINE LIST N°
							19-L-19-000-2-00-80602
							PIPE LAYOUT N°
							19-L-19-000-2-00-86198 sheet 1
00	ISSUED FOR REFERENCE	28-APR-23	U.CHAVAN	P.VAZE	G.PAGANONI		
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	

ISSUED FOR REFERENCE



Signature for construction is shown on Iso list of relevant CWA

ISOMETRIC DRAWING LINE

3/4"-CWR-40B02-B-1 (P)

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A13/4XS> (L-6679)	3/4	I132785	3.6 M	
FITTINGS					
2	90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD <90FA300LBK3/4> (L-178)	3/4	I1651298	4	
FLANGES					
3	SW FLANGE ASME B16.5 150# A105N RFFE SWE 125 - 250 AARH F02CDC44B105 S-XS <SWFA300R153/4XS> (L-295)	3/4	I5378342	2	
GASKETS					
4	FLAT RING GASKET ASME B16.21 150# RFTBE NA/ARAMIDIC/NBR ASME B16.5 G02HDP2QR01 <NMGQ009R1FC3/4> (L-NMG11)	3/4	I1655202	2	
BOLTS					
5	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G1/221/2> - 2 NUTS PER BOLT - 65 mm Length	1/2	I53437190	8	
VALVES / IN-LINE ITEMS					
6	BALL VALVE BS EN ISO 17292 150# A216-WCB RFFE 304/R-PTFE, GF B7/2H 125 - 250 AARH 2PSB-FULL BORE FLOATING BALL LE ASME B16.5 V04FDC29B1X NREQD <B43_4L-AL049> (L-AL049)	3/4	I1943748	1	

PIPE MATERIAL	NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".		
CS			
HEAT TREATMENT (PWHT)			
N			
PAINTING SCHEME (3)			
1	CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
PIPING CLASS		4274-XH-DL-2121CWR40B02-5	4001008
B-1	 LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX		
WELDING CLASS (4)			
E	DRAWING NUMBER 19-000-2-02-00001 sheet 2121CWR40B02-5		
PED CATEGORY			
III	ANNEX 19 SPEC. L		
INSULATION CODE / THK. (mm)			
P 50	REV. 00		