


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 04-09-2023 09:36:26      STREAM NO.:4526      REV. CAUSE ID:

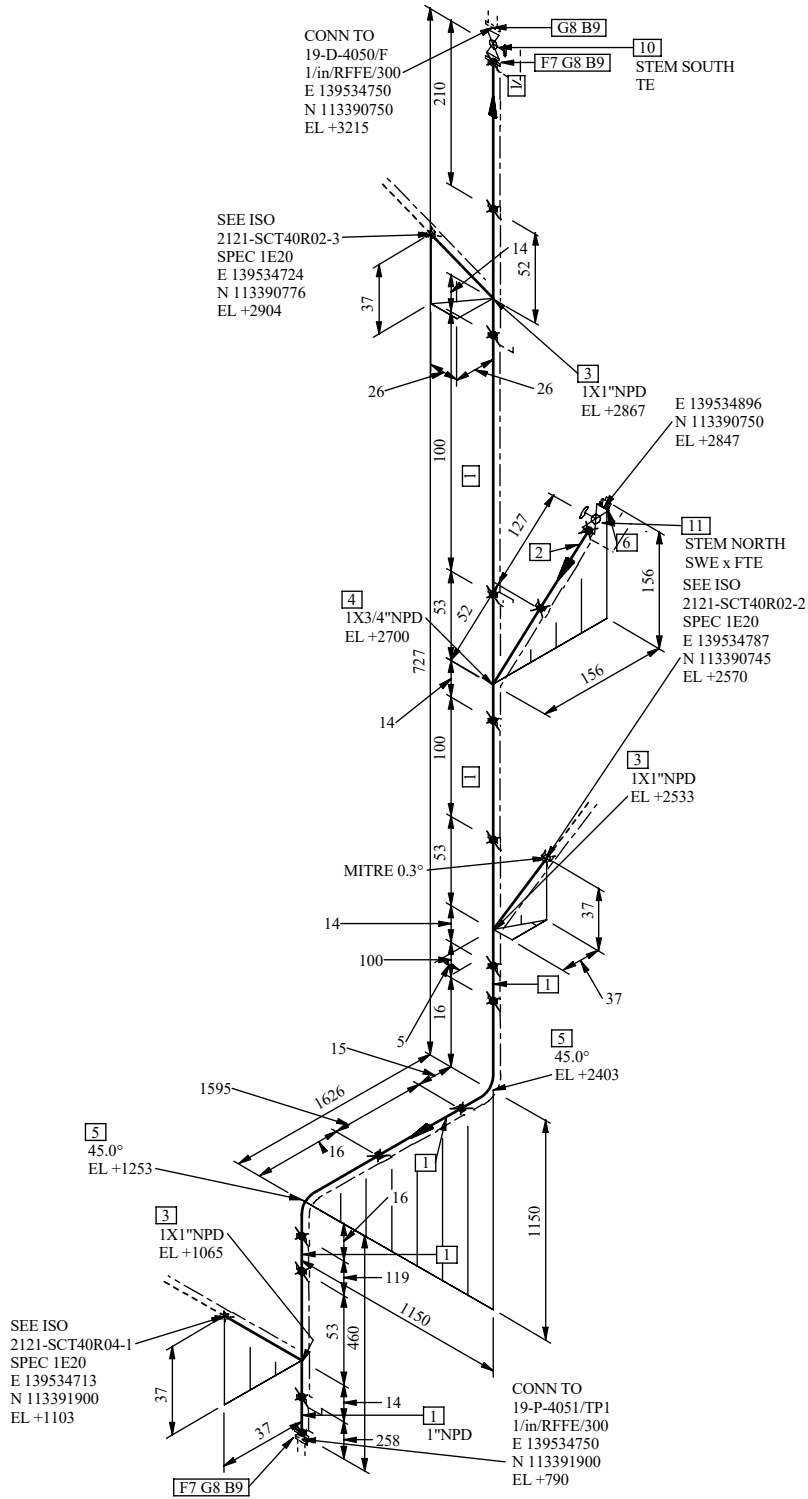

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FE0A05 AND FE019.

SUPPORTS LEGEND: DENOTES PARTS LIST NO      PIPE SUPPORT A=RESTING SUPPORT      G=GUIDE      F=AXIAL STOP      B=ANCHOR      M=SPRING      S=TEFLON PAD  
WHERE WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID 19-A-19-000-1-01-00001 sheet 46
00	ISSUED FOR REFERENCE	04-SEP-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86197 sheet 1

ISSUED FOR REFERENCE



Signature for construction is shown on Iso list of relevant CWA

ISOMETRIC DRAWING LINE

1"-SCT-40R02-1E20 (ET)

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A11XS> (L-6679)	1	I132793	2.4 M	
2	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A13/4XS> (L-6679)	3/4	I132785	0.1 M	
FITTINGS					
3	45 LATERAL ASME B16.11/AA 3000# A105N SWE SWE - R17RNC441101 Undefined <LTSA300LBK1> (L-LTS03)	1X1	I11139836	3	
4	REDUCING 45 LATERAL ASME B16.11/AA 3000# A105N SWE SWE - R18RNC441101 Undefined <LR4A300LB1211> (L-LR403)	1X3/4	I63782626	1	
5	45 ELBOW ASME B16.11 3000# A105N SWE SWE - R32FNC441101 NREQD <45FA300LBK1> (L-184)	1	I1651292	2	
6	PLUG ROUND HEAD ASME B16.11 - A105N MTE NREQD - R42FQC44W001 NREQD <PLUA300CK3/4> (L-77)	3/4	I10088232	1	
FLANGES					
7	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R351XS> (L-375)	1	I4217823	2	
GASKETS					
8	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP11S12 <N/A> (N/A)	1	I63508951	3	
BOLTS					
9	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G5/831/4> - 2 NUTS PER BOLT - 80 mm Length	5/8	I53437418	12	
VALVES / IN-LINE ITEMS					
10	BALL VALVE API 608 300# A216-WCB RFFE 316/R-PTFE, GF B7/2H 125 - 250 AARH 2PSB-FULL BORE FLOATING BALL OHW ASME B16.5 V04JFC29BZZG NREQD <B41L-AL084> (L-AL084)	1	I9918107	1	
11	BALL VALVE API 608 800# A216-WCB SWE FTE 316/R-PTFE, GF B7/2H 2PSB-FULL BORE FLOATING BALL OHW V04JIC2912ZZV NREQD <N/A> (N/A)	3/4	I66529817	1	

PIPE MATERIAL		NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "~N/A~" MEANS UNICODE IS "NOT AVAILABLE".			
CS					
HEAT TREATMENT (PWHT)					
N					
PAINTING SCHEME (3)			CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
20				4274-XH-DL-2121SCT40R02-1	4001008
PIPING CLASS					
1E20					
WELDING CLASS (4)		 <div>LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT</div> <div>CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX</div>			
E					
PED CATEGORY					
Art 4.3					
INSULATION CODE / THK. (mm)		ANNEX	SPEC.	DRAWING NUMBER	REV.
ET 30		19	L	19-000-2-02-00001 sheet 2121SCT40R02-1	00