


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT
PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 27-03-2023 10:30:25

STREAM NO.:4005

REV. CAUSE ID: 7

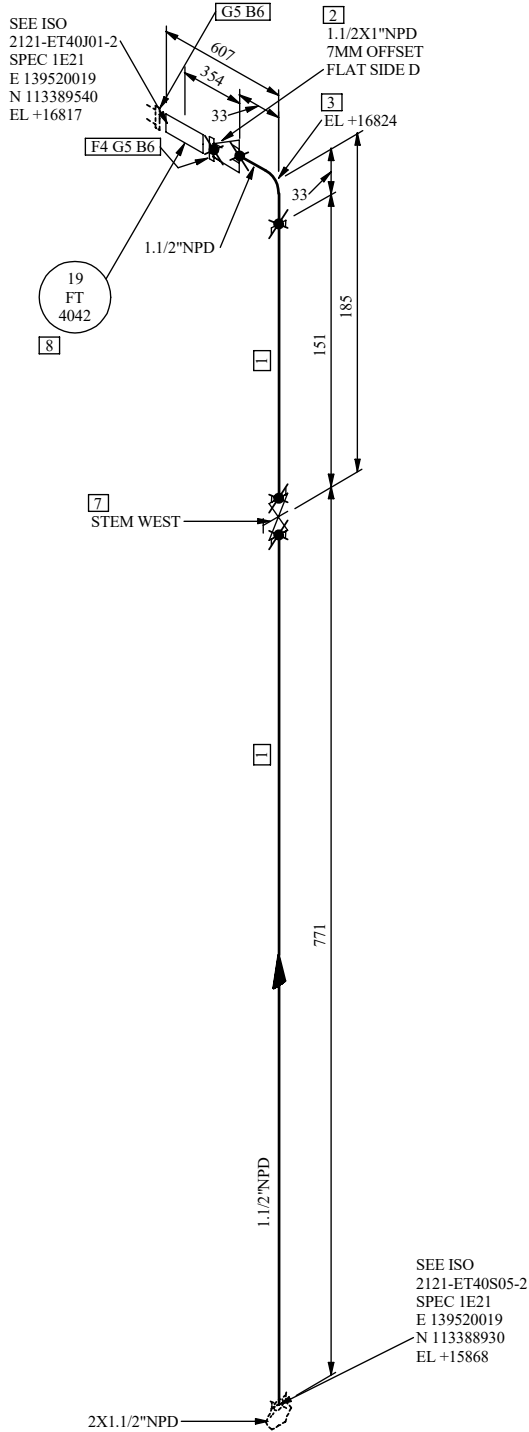

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✕ , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND: [] DENOTES PARTS LIST NO PIPE SUPPORT A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE [] WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID
							19-A-19-000-1-01-00001 sheet 40
00	ISSUED FOR REFERENCE	24-MAR-2023	M.YADAV	P.VAZE	G.PAGANONI		LINE LIST N°
							19-L-19-000-2-00-80602
							PIPE LAYOUT N°
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	19-L-19-000-2-00-86197 sheet 5

ISSUED FOR
REFERENCE

Signature for construction is shown
on Iso list of relevant CWA

ISOMETRIC DRAWING
LINE

1-1/2"-ET-40J01-1E21

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B PE SMLS T01AC03Z02 S-XS <PIPA010A111/2XS> (L-6679)	1.1/2	I132809	0.9 M	
FITTINGS					
2	ECCENTRIC SWAGE MSS SP-95 - A105N PE PE SMLS SCH1-XS SCH2-XS R22FQC44ZZ01 <ESWA010AR13161216> (L-ESW31)	1.1/2X1	I62946435	1	
3	90 ELBOW ASME B16.11 3000# A105N SWE SWE - R31FNC441103 NREQD <90FA300LBK11/2> (L-178)	1.1/2	I1651297	1	
FLANGES					
4	SW FLANGE ASME B16.5 300# A105N RFFE SWE 125 - 250 AARH F02CFC44B105 S-XS <SWFA300R351XS> (L-375)	1	I4217823	1	
GASKETS					
5	SPIRAL WOUND GASKET ASME B16.20 300# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GFP1ISI2 <N/A> (N/A)	1	I63508951	2	
BOLTS					
6	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G5/831/4> - 2 NUTS PER BOLT - 80 mm Length	5/8	I53437418	8	
VALVES / IN-LINE ITEMS					
7	GATE VALVE API 602 800# A105N SWE SWE 8-F6&HF WB-OS&Y SOW API 602 HW V01GIC4411BL NREQD <G611_2L-GA1313-B> (L-GA1313-B)	1.1/2	I10015421	1	
INSTRUMENTS					
8	INSTRUMENT COMPONENT	1	I9-FT-4042	1	

PIPE MATERIAL

CS

HEAT TREATMENT (PWHT)

N

PAINTING SCHEME (3)

1

PIPING CLASS

1E21

WELDING CLASS (4)

E

PED CATEGORY

II

INSULATION CODE / THK. (mm)

N

0

- NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.
2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102.
3. WELDING ACCORDING TO 45-L-45-000-2-00-80021.
4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160.
5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "~N/A~" MEANS UNICODE IS "NOT AVAILABLE".



LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT

ANNEX 19 SPEC. L DRAWING NUMBER 19-000-2-02-00001 sheet 2121ET40J01-1

REV. 00