

THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).


EXTR. DATE: 22-07-2023 07:46:04

STREAM NO.:4036

REV. CAUSE ID:



TAIL S 86 E
JACK SCREWS TO BE SUPPLIED BY MECHANICAL CONTRACTOR.
THE DRILLING AND THREADING FOR JACK SCREW SHALL BE DONE BY MECHANICAL CONTRACTOR ACCORDING TO PE-L-0100.13 "JACK SCREW".

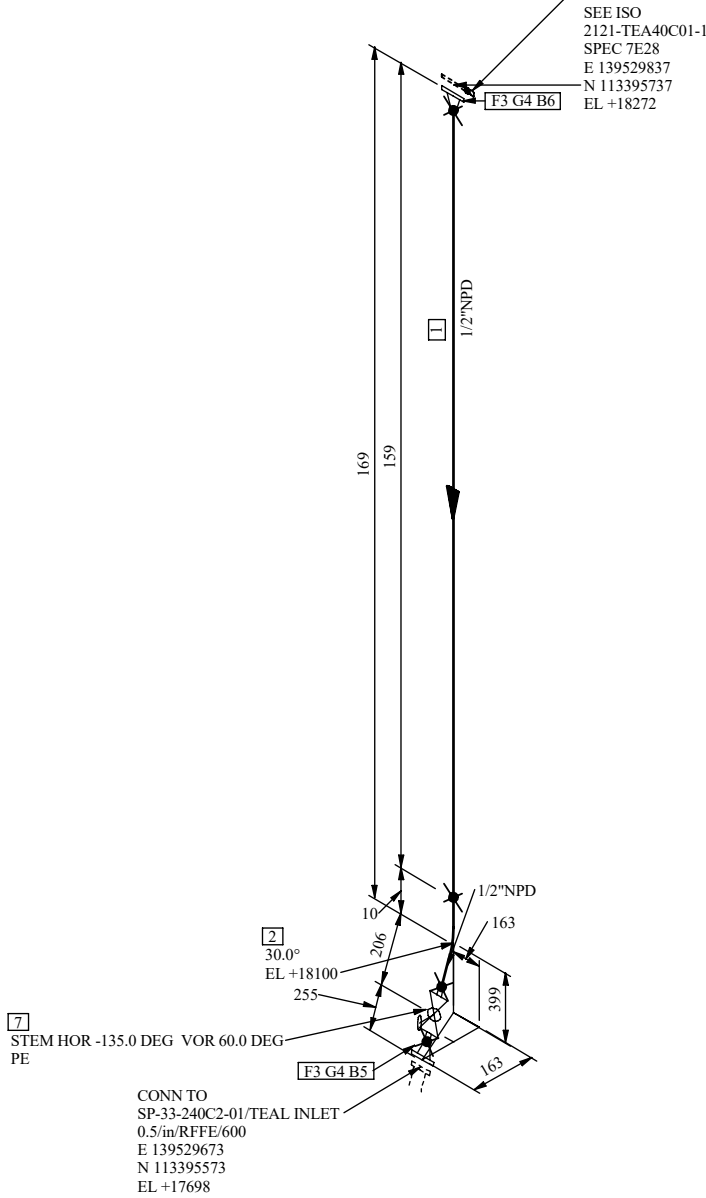

REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND: DENOTES PARTS LIST NO PIPE SUPPORT A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD
WHERE WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

							STRESS CALC. N°
							-
							P & ID 19-A-19-000-1-01-00001 sheet 32
00	ISSUED FOR REFERENCE	21-JUL-23	U.CHAVAN	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86197 sheet 5

ISSUED FOR
REFERENCE

Signature for construction is shown
on Iso list of relevant CWA

ISOMETRIC DRAWING
LINE

1/2"-TEA-40C01-7E28

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A312-TP304/304L DUAL GR PE SMLS T01AL2CZ02 S-80S <PIPB04DA21/280S> (L-PIP110)	1/2	12257955	0.1 M	
FITTINGS					
2	45 LR ELBOW ASME B16.9 A403-WP304/304L DG BE SMLS C02DL2FV01 S-80S <45LB23DF31/280S> (L-45L26)	1/2	12376173	1	
FLANGES					
3	WN FLANGE ASME B16.5 600# A182-F316/316L DUAL GR RFFE BE 125 - 250 AARH F01CHL1MBV05 S-80S <> ()	1/2	12254580	2	
GASKETS					
4	SPIRAL WOUND GASKET ASME B16.20 600# RFTBE 304/GRAFOIL SS 304 SS 304 ASME B16.5 G03GHP1IS04 <N/A> (N/A)	1/2	11169016	2	
BOLTS					
5	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G1/231/4> - 2 NUTS PER BOLT - 80 mm Length	1/2	153437223	4	
6	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G1/231/2> - 2 NUTS PER BOLT - 90 mm Length	1/2	153437245	4	
VALVES / IN-LINE ITEMS					
7	NIPPLED BALL VALVE BS EN ISO 17292 800# A182-F316/316L DUAL GR PE PE 316/PEEK A193-B8M CL2/8MA 3PSB-FULL BORE FLOATING BALL OHW SCH1-80S SCH2-80S LENGTH 75mm V36FIL1MZZAQ NREQD <B61_2L-AL293> (L-AL293)	1/2	164005281	1	

- NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST.
2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102.
3. WELDING ACCORDING TO 45-L-45-000-2-00-80021.
4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160.
5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "~N/A~" MEANS UNICODE IS "NOT AVAILABLE".

CONTRACTOR:	CONTRACTOR DRAWING NUMBER:	PROJECT:
	4274-XH-DL-2121TEA40C01-5	4001008

LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS CLIENT / COMPLEX
FOR PROJECT - ALBA PROJECT REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX

ANNEX 19	SPEC. L	DRAWING NUMBER 19-000-2-02-00001 sheet 2121TEA40C01-5	REV. 00
----------	---------	---	---------